



CODE ENFORCEMENT AUTHORITIES: CITY OF PUYALLUP - DEVELOPMENT & PERMITTING SERVICES

- CODES IN EFFECT: 2018 WASHINGTON STATE BUILDING CODE, CHAPTER 51-50 WAC, 2018 IBC AS AMENDED. 2018 WASHINGTON STATE EXISTING BUILDING CODE. 2018 IEBC AS AMENDED. 2018 WASHINGTON STATE FIRE CODE, CHAPTER 51-4QA WAC, 2018 IFC AS AMENDED. 2018 WASHINGTON STATE MECHANICAL CODE, CHAPTER 51-52 WAC, 2018 IMC AS AMENDED. NATIONAL ELECTRICAL. CODE 2020 OF WASHINGTON, INCLUDING NFPA 70. PUYALLUP MUNICIPAL CODE - INCLUDING TITLE 16 FIRE AND TITLE 17 BUILDINGS AND CONSTRUCTION. NFPA 13-2016.
- PROJECT DESCRIPTION:
- SCOPE OF WORK CONSISTS OF INTERIOR ALTERATIONS LIMITED TO DEMOLITION OF NON STRUCTURAL ELEMENTS, CONSTRUCTION OF NON-LOADBEARING PARTITIONS. MODIFICATIONS TO AFFECTED CEILINGS, AND INSTALLATION OF SHELVING AND MILLWORK. EXISTING LOADING DOCK AREA INCLUDES OWNER-FURNISHED SHELVING UNITS FOR MERCHANDISE AND SPACE FOR ORDER PROCESSING.
- NO CHANGE OF USE IS PROPOSED. NO CHANGES TO THE EXISTING BUILDING ENVELOPE PROPOSED.
- AREA OF WORK: 1,000 SF.
- USE AND OCCUPANCY:
- EXISTING GROUP M, MERCANTILE DEPARTMENT STORE NO CHANGE TO OCCUPANCY TYPE.
- TYPES OF CONSTRUCTION: TYPE IB (ORIGINAL CONSTRUCTION UBC TYPE II-FR) **GENERAL BUILDING HEIGHTS AND AREAS:**
- AREA: NO CHANGE TO BUILDING AREA HEIGHT: NO CHANGE TO BUILDING HEIGHT
- MEANS OF EGRESS EXISTING EXIT LOCATIONS TO REMAIN, NO CHANGES.
- OCCUPANT LOAD NO CHANGES TO EXISTING USE OR OCCUPANCY LOADS.
- SPRINKLERS EXISTING BUILDING IS FULLY SPRINKLERED.

#### WORK EXEMPT FROM PERMIT

- THIS PROJECT INCLUDES WORK THAT IS EXEMPT FROM PERMIT REQUIREMENTS OF THE CODE. IN ACCORDANCE WITH BUILDING CODE SECTION 105.2, INCLUDING (BUT NOT LIMITED TO): • PAINTING, TILING, CARPETING, COUNTERTOPS, AND SIMILAR FINISH WORK.
- NONFIXED AND MOVABLE SHELVES NOT OVER 5 FEET 9 INCHES IN HEIGHT.

#### SEISMIC DESIGN DATA

- A. RISK CATEGORY: II SEISMIC IMPORTANCE FACTOR: IP = 1.0
- B. MAPPED SPECTRAL RESPONSE ACCELERATIONS: SS = 1.264 S1 = 0.436
- C. SITE CLASSIFICATION: D D. DESIGN SPECTRAL RESPONSE COEFFICIENTS: SDS = 1.011 SD1 = 0.813 E. SEISMIC DESIGN CATEGORY: D

#### **GENERAL NOTES**

- A. COMPLY WITH CODES AND STANDARDS IN EFFECT AND AUTHORITIES HAVING JURISDICTION: WHERE REQUIREMENTS CONFLICT. COMPLY WITH THE MOST
- STRINGENT PROVISIONS. B. PROVIDE AND MAINTAIN REQUIRED EGRESS FROM BUILDING AND ALL AREAS WITHIN STRUCTURE AT ALL TIMES DURING DEMOLITION AND CONSTRUCTION.
- PROVIDE AND MAINTAIN BARRIERS AND OTHER PROTECTIONS TO ENSURE SAFE PASSAGE IN AND AROUND THE FACILITY. CONTRACTOR REMAINS SOLELY RESPONSIBLE FOR SAFETY AND SECURITY
- DURING THE WORK. D. MAINTAIN AREAS ADJACENT TO THE WORK CLEAN AT ALL TIMES. REMOVE DEBRIS REGULARLY, NOT LESS THAN DAILY, OR MORE OFTEN AS REQUIRED.
- E. FIELD VERIFY EXACT SIZE, EXTENT, TYPE AND LOCATIONS OF PLUMBING, MECHANICAL, ELECTRICAL, FIRE PROTECTION, COMMUNICATIONS AND DATA PENETRATIONS. OPENINGS. ROUGH-IN, AND SIMILAR PROVISIONS
- WITH RESPECTIVE CONTRACTORS PRIOR TO CONSTRUCTION. F. EXISTING CONDITIONS TO BE EXPECTED MAY INCLUDE CONCEALED CONDITIONS. CONTRACTOR SHALL NOTIFY GENERAL CONTRACTOR OF
- UNEXPECTED CONDITIONS THAT WOULD MODIFY SCOPE OF WORK. CONTRACTOR TO OBTAIN WRITTEN AUTHORIZATION BEFORE PROCEEDING G. FIELD VERIFY DIMENSIONS, ELEVATIONS, AND CONDITIONS INDICATED ON DRAWINGS PRIOR TO FABRICATION OF MATERIALS AND COMMENCEMENT OF
- WORK IN AREA OR SEQUENCE. REPORT ANY DISCREPANCIES TO OWNER PRIOR TO PROCEEDING WITH AFFECTED WORK. DO NOT SCALE DRAWINGS, PLANS OR DETAILS TO DETERMINE WORKING DIMENSIONS. H. PREPARE EXISTING SURFACES AND SUBSTRATES AS REQUIRED TO FACILITATE AND ACCEPT CONSTRUCTION INDICATED.
- DO NOT OVERLOAD OR OTHERWISE EXCEED CAPACITY OF STRUCTURE TO CARRY TEMPORARY, CONSTRUCTION, OR PERMANENT LOADS. UNLESS OTHERWISE INDICATED DO NOT HANG OR OTHERWISE SUPPORT ANY ITEMS FROM METAL ROOF OR FLOOR DECK. . PATCH AND REPAIR EXPOSED SURFACES AND FINISHES DISTURBED OR
- AFFECTED. MATCH EXISTING SURFACES WHERE NEW CONSTRUCTION ABUTS OR IS ADJACENT TO EXISTING. ALIGN AND FINISH TRANSITIONS TO ACHIEVE SMOOTH, CONTINUOUS, UNIFORM SURFACES TRUE TO LINE AND ELEVATION.
- K. PATCH AND REPAIR GYPSUM BOARD SURFACES AFFECTED BY THE WORK TO ACHIEVE UNIFORM SURFACES TO RECEIVE PAINT. GYPSUM BOARD FINISH INSIDE THE SCOPE OF WORK NON COSTUMER FACING
- IS LEVEL 3. OUTSIDE THE COSTUMER FACING, IT IS LEVEL 4 UNLESS LEVEL 5 IS SPECIFICALLY REQUIRED. M. COORDINATE STAGING AREA AND DUMPSTER LOCATIONS WITH PROPERTY MANAGER.

## **DELEGATED DESIGN NOTES**

- A. PORTIONS OF THE PROJECT ARE DESIGNATED FOR DELEGATED DESIGN, INCLUDING: - FIRE PROTECTION - FIRE ALARM
- B. DELEGATED DESIGN CONTRACTOR SHALL PREPARE DOCUMENTS, ENGINEERING SERVICES, ENGINEERED SHOP DRAWINGS, ACTION SUBMITTALS, AFFIDAVITS, TESTING RESULTS, AND OTHER INFORMATION REQUIRED FOR REVIEW AND APPROVAL BY AUTHORITIES HAVING JURISDICTION.
- DELEGATED DESIGN CONTRACTOR IS RESPONSIBLE TO COORDINATE WITH WORK INDICATED IN THESE DOCUMENTS. NOTIFY ARCHITECT IF CONFLICT ARISES.

SHEET NO. 03 AR A00 A10 A50 A5 09 IN



MEP ENGINEER: PRATER ENGINEERING ASSOCIATES, INC. 6130 WILCOX RD, DUBLIN, OH 43016 ATT: ANDREW PRATER 614-766-4896 APRATER@PRATERENGR.COM



EXIT AT


GRADE



STORE ENVIRONMENT Store Planning • Architecture Construction • Engineering 145 Progress Place Springdale, OH 45246



16 East 12th Street, Cincinnati OH 45202 (513) 549-6879 architecture359.com




#### \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_ \_\_\_\_\_ \_\_\_\_ \_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_ \_\_\_\_\_ ·\_\_\_\_ · \_\_\_\_\_ \_\_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_ \_\_\_\_\_ \_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_ \_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_ \_\_\_\_\_ \_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_ \_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ <u>\_\_\_\_</u> \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_\_ \_\_\_\_ ------\_\_\_\_\_ A BID AND PERMIT 9/28/2022 NO. REVISIONS DATE MACY'S SOUTH HILL MALL 3500 SOUTH MERIDIAN, SUITE 985 PUYALLUP, WA 98373 PROJECT INTERIOR ALTERATIONS ARCHITECT'S **202100475** PROJECT NO. SHEET TITLE COVER SHEET SHEET NO

A001.2

### SHEET INDEX

SHEET			
NO.	SHEET NAME		
03 ARCHITE	ECTURAL		
A001.2	COVER SHEET		
A101.2	ENLARGED PLANS AND DETAILS		
A501.2	PARTITION DETAILS		
A502.2	CEILING DETAILS		
09 INTERIO	R DESIGN		
1 - 1	FIRST FLOOR MERCHANDISE PLAN		
1 - 8	FIRST FLOOR FLOORCOVERING & FINISH PLAN		
2 - 11	SECTIONS, DETAILS & FINISH SPECIFICATIONS		
2 - 20	INTERIOR ELEVATIONS		
2 - 22	INTERIOR ELEVATIONS		
23 MECHAN	NICAL		
H1-1	1ST FLOOR HVAC DEMOLITION AND NEW WORK PLANS		
26 ELECTR	26 ELECTRICAL		
E1-1	1ST FLOOR ELEC. DEMO AND NEW WORK PLANS, DETAILS, SCHEDULE AND ONE LINE		
E1-1A	1ST FLOOR SALES AREA ELEC. DEMO AND NEW WORK PLANS		

Reviewed 3/22/2023 DL Subject to field inspectors approvals per Inspector.



City of Puyallup Development & Permitting Services ISSUED PERMIT			
Building Planning			
Engineering Public Works			
Fire Traffic			

FULL SIZED LEDGIBLE <u>COLOR</u> PLANS ARE REQUIRED TO BE PROVIDE BY THE PERMITTEE ON SITE FOR ALL INSPECTIONS MIN. PLAN SIZE 48 X 36

**REVISION TO ORIGINAL PERMIT TO ADD SOME** WALLS ON THE MEZZANINE AREA.


**PROJECT CONTACTS** 

ARCHITECT: ANDREW C. HARTE, ARCHITECT 16 EAST 12TH STREET, CINCINNATI, OH ATT: BRETT FLODDER 513-277-0511 BFLODDER@ARCHITECTURE359.COM

TENANT COORDINATOR THE CAFARO COMPANY 5577 YOUNGSTOWN-WARREN RD. NILES, OHIO 4446 330-747-2661 X-209 TEFT@CAFAROCOMPANY.COM


PROPERTY MANAGER KEVIN HOVEY


3500 S. MERIDIAN ST., UNIT 494 PUYALLUP, WA 98373 253-840-2828 PROPERTYMANAGER@SOUTHHILLMALL.COM **PRCTI20221484** 

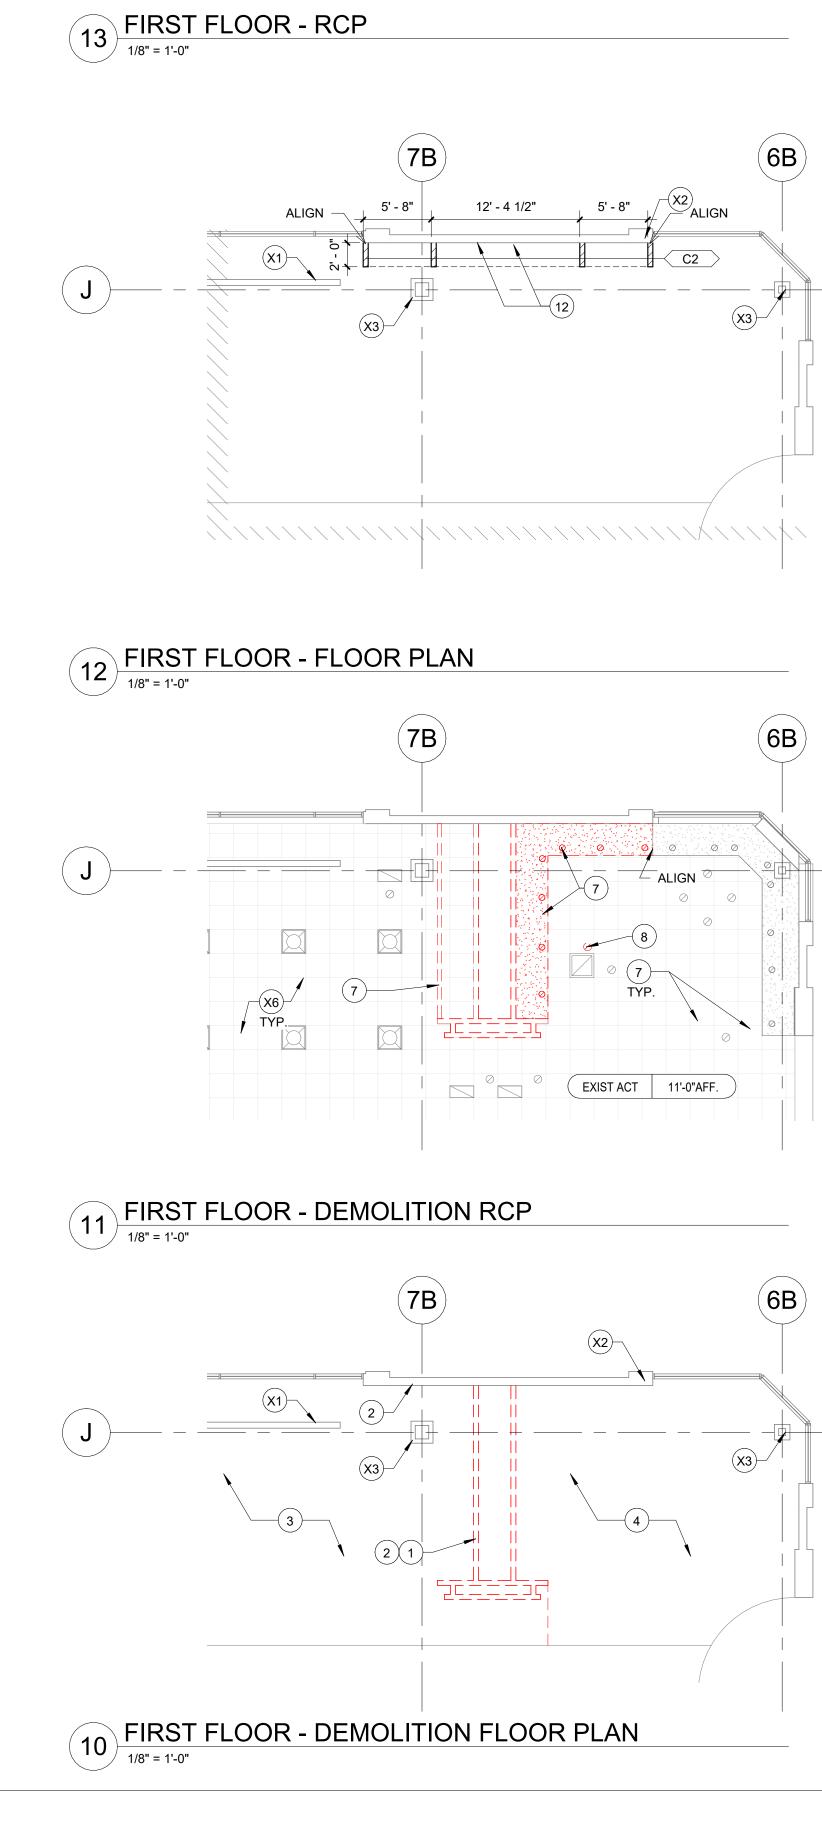


\_\_\_\_


J

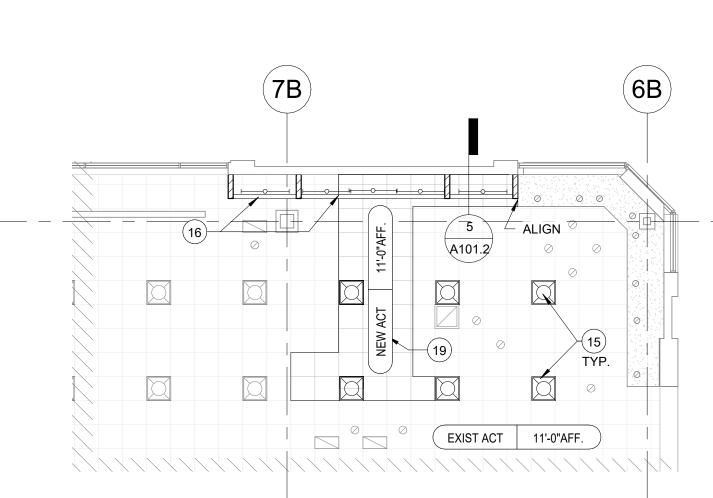

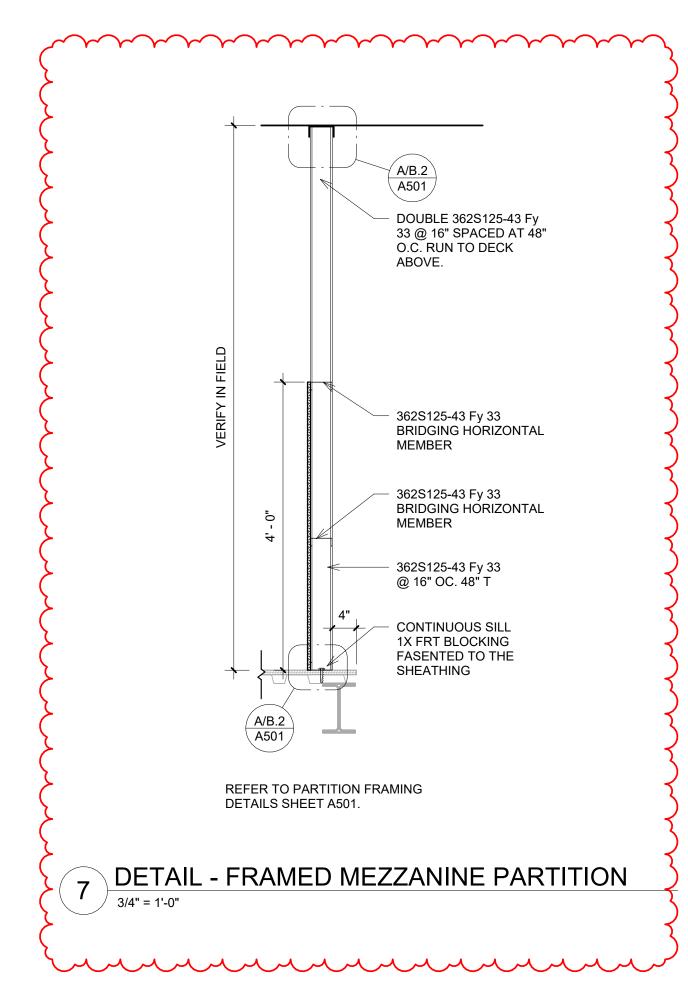


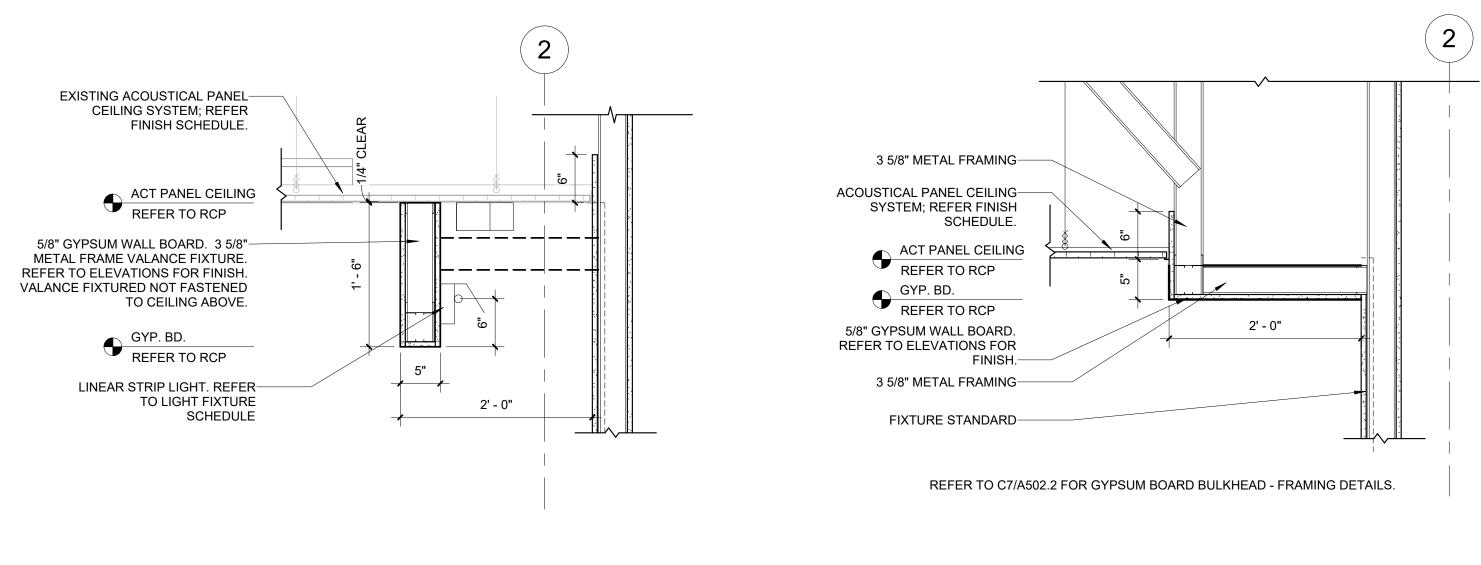


5 RCP DETAIL - VALANCE FIXITURE

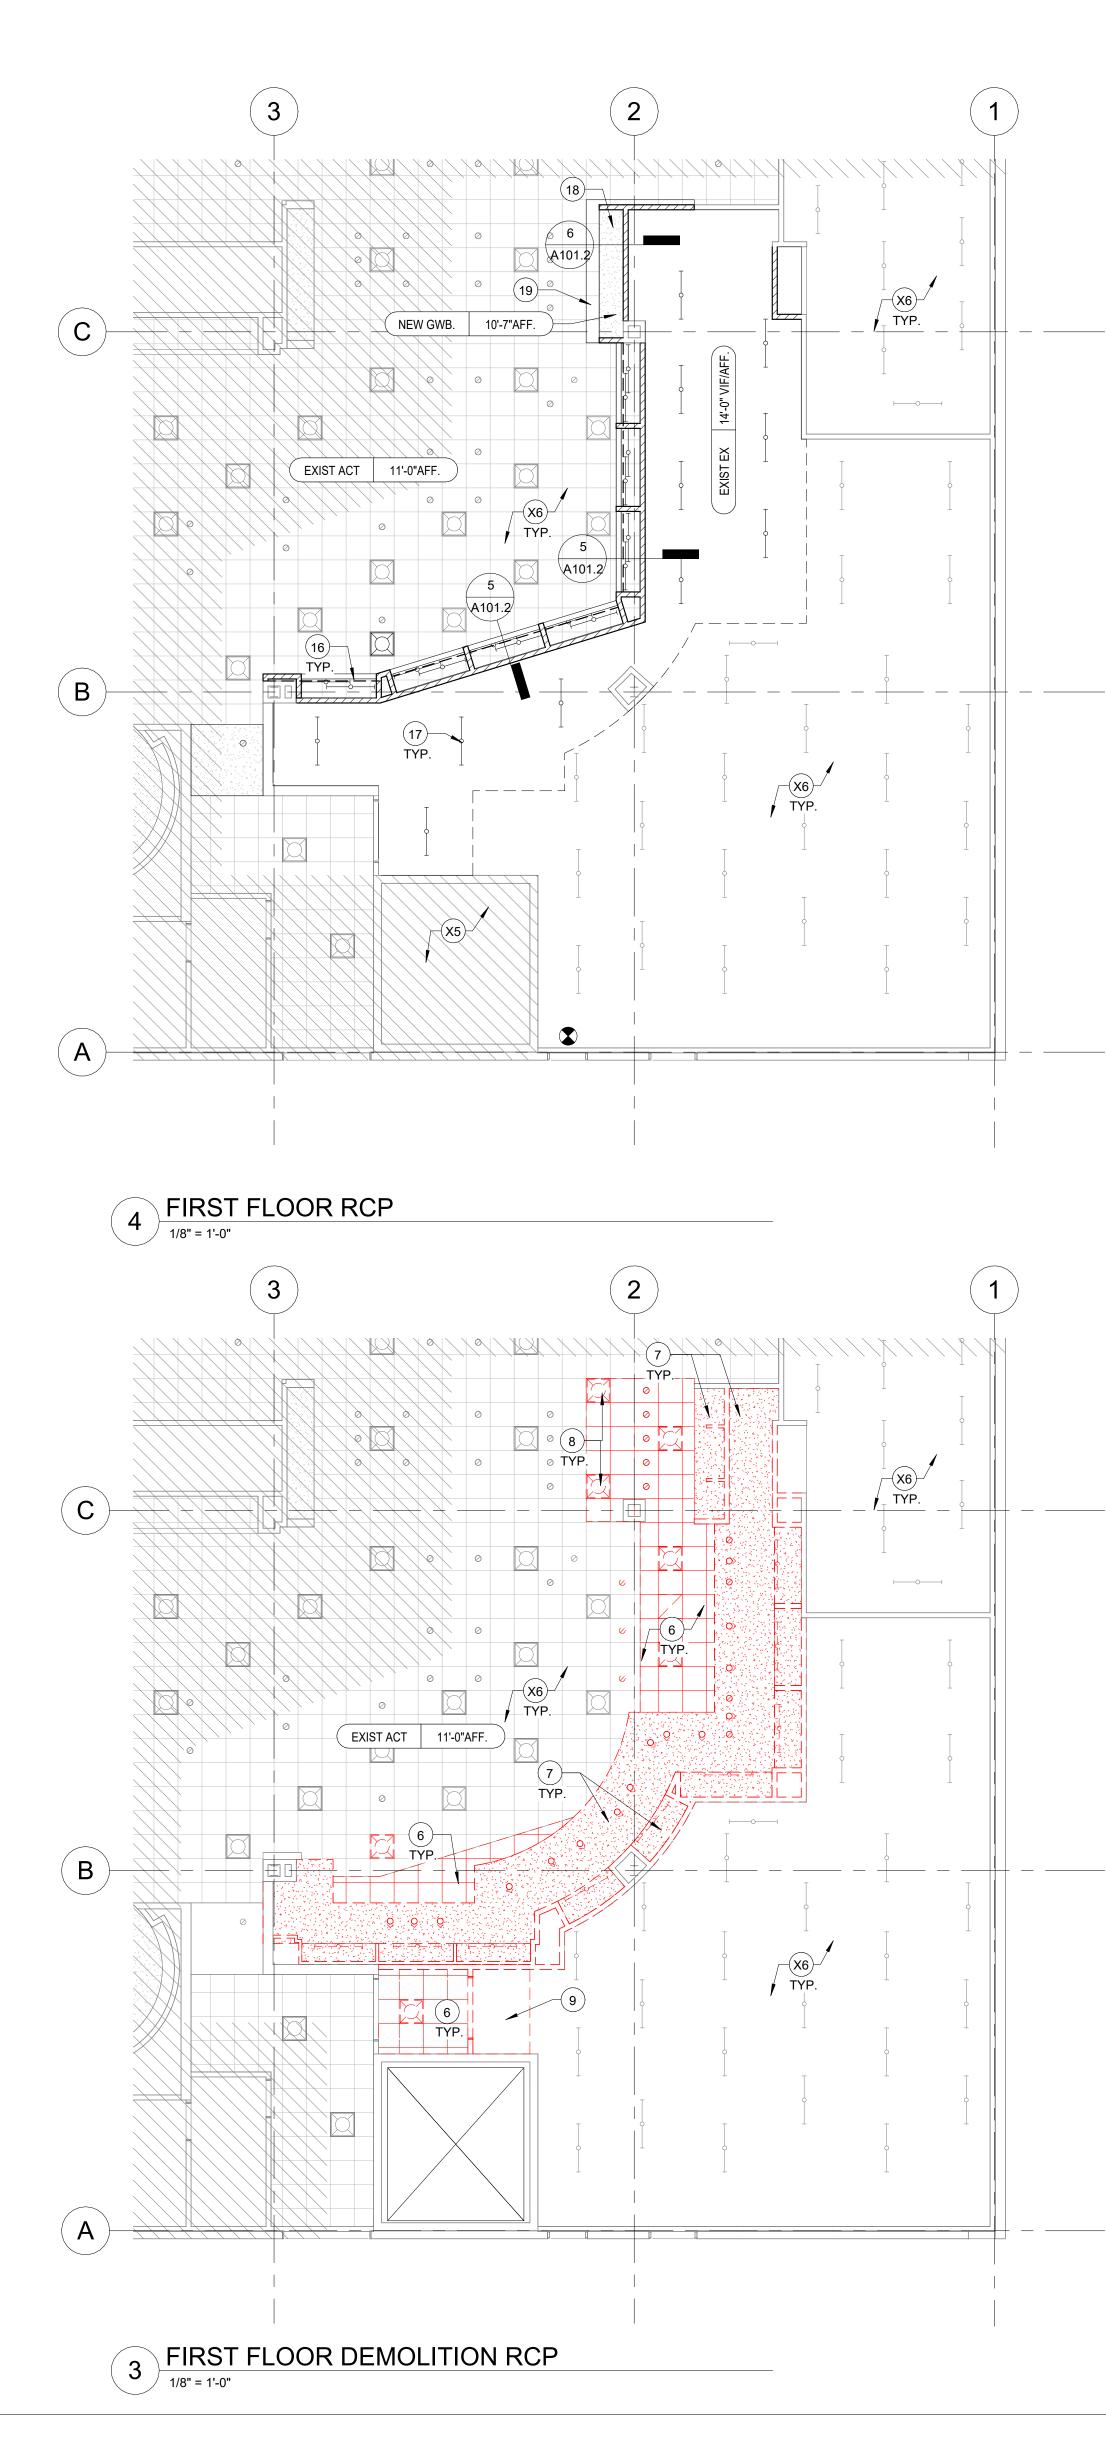



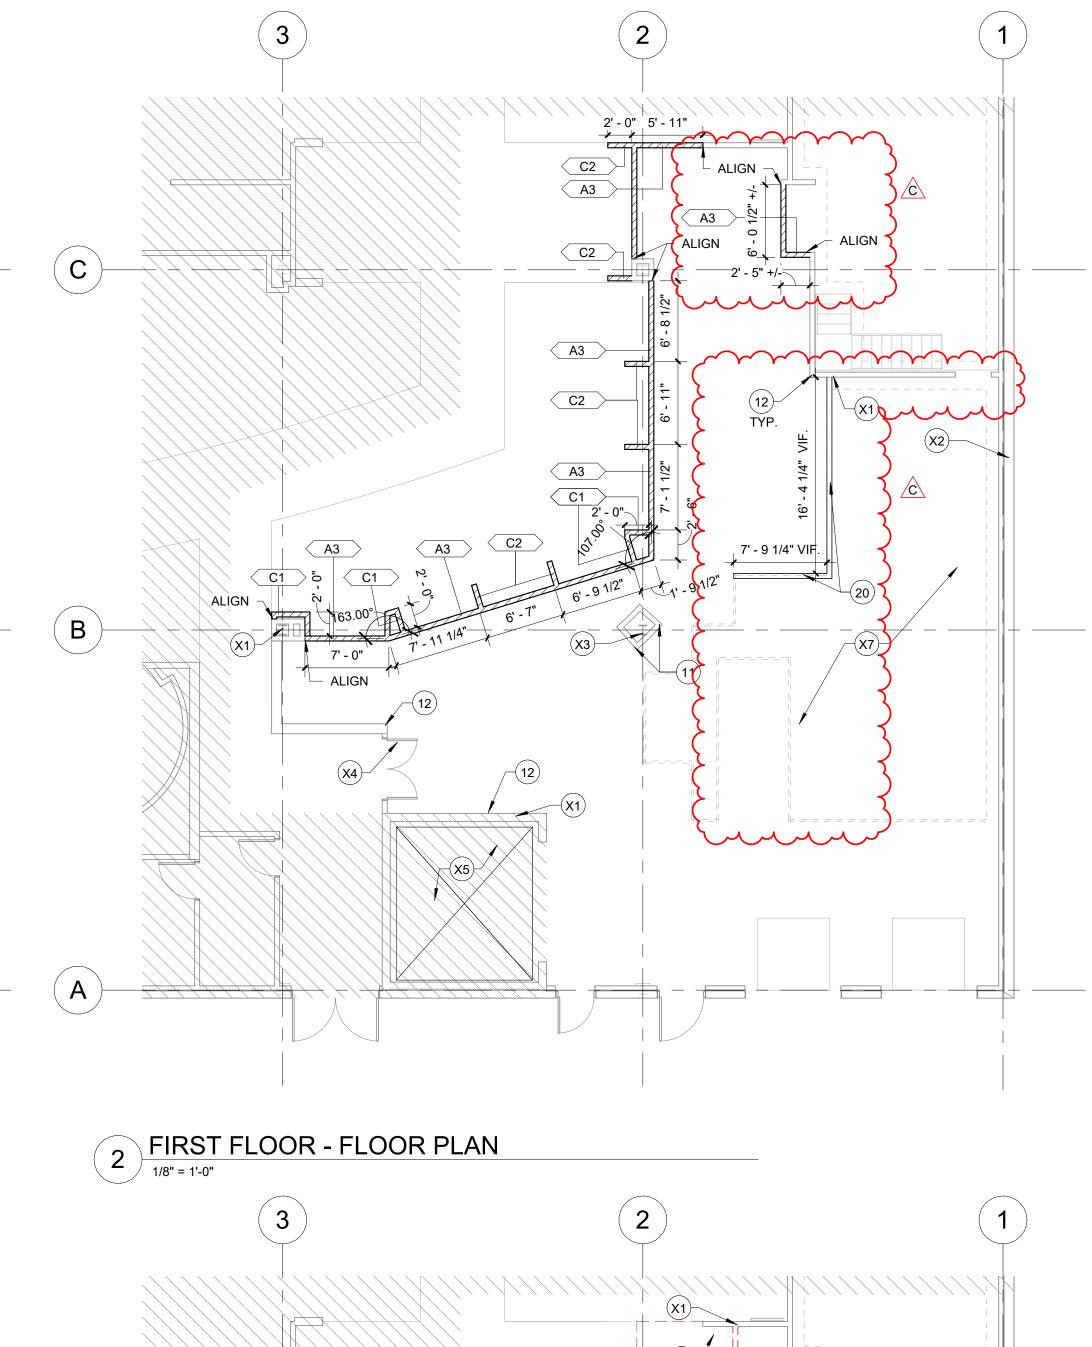

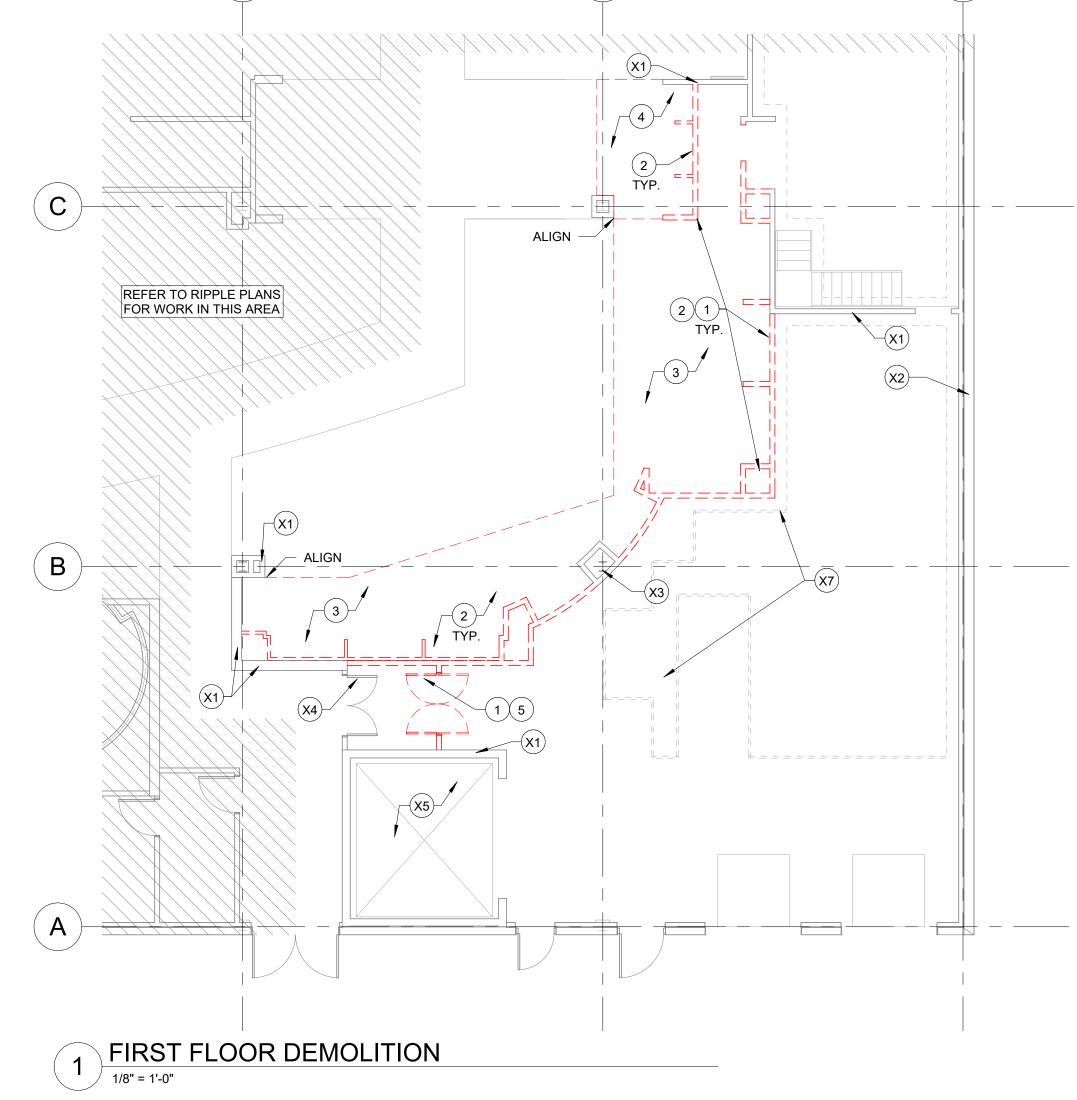

### **GENERAL NOTES**

ITEMS.

- A. REFER TO MEP PLANS FOR MECHANICAL, ELECTRICAL, AND PLUMBING WORK.
- B. DESIGN INTENT WITHIN THE OFFICE AREA IS TO LEAVE THE EXISTING CEILING, LIGHTS, SPRINKLERS AND CEILING-MOUNTED DEVICES
- INTACT, AS MUCH AS POSSIBLE. C. REFER TO HVAC AND ELECTRICAL PLANS FOR LIGHT FIXTURES, HVAC DIFFUSERS AND GRILLES, AND OTHER CEILING-INSTALLED

### **EXISTING KEYNOTES**


- PROTECT EXISTING CONSTRUCTION TO REMAIN X1. EXISTING PARTITION TO REMAIN.
- EXISTING EXTERIOR WALL TO REMAIN. X2 EXISTING COLUMN TO REMAIN. X3.
- X4. EXISTING DOOR TO REMAIN. X5. EXISTING FREIGHT ELEVATOR AND SHAFT WALLS TO REMAIN.
- X6. EXISTING LIGHTING TO REMAIN CLEAN AND RELAMP FIXTURES AS REQUIRED. EXISTING STOCK ROOM MEZZANINE TO REMAIN. PROTECT FROM X7.

#### **DRAWING NOTES**

DAMAGE.

- . REMOVE NON-LOAD BEARING INTERIOR PARTITION IN ITS ENTIRETY. REMOVE DOORS, FRAMES AND WALL-MOUNTED FIXTURES AND DEVICES
- AFFECTED. . REMOVE RETAIL FIXTURES AND FURNISHINGS - COORDINATE SALVAGE
- REQUIREMENTS WITH OWNER. REMOVE CARPETING, INCLUDING ADHESIVES, MASTICS, LOOSE AND UN-
- BONDED FILLS AND COMPOUNDS, TRANSITIONS AND ACCESSORIES IN ENTIRETY TO CONCRETE FLOOR SURFACE. 4. REMOVE FLOOR TILE INCLUDING ADHESIVES, MORTAR, LOOSE AND
- UNBONDED FILLS AND COMPOUNDS, TRANSITIONS AND ACCESSORIES IN ENTIRETY TO CONCRETE FLOOR SURFACE. . REMOVE DOOR INCLUDING FRAMES, ANCHORS, FASTENERS,
- HARDWARE, AND RELATED ACCESSORIES IN ENTIRETY. 6. REMOVE EXISTING ACT CEILING PADS, GRID AND LIGHTING. SALVAGE EXISTING PADS TO REPLACE DAMAGED OR DISCOLORED PADS IN SCOPE
- AREA. . REMOVE EXISTING GWB CEILING AND LIGHTING. 8. REMOVE EXISTING LIGHT FIXTURE REPLACE WITH SALVAGED ACT PAD.
- 9. REMOVE EXISTING STORAGE SHELF ABOVE DOOR. 10. INFILL EXISTING DOOR FRAME AND OPENING. PARTITION CONSTRUCTION TO MATCH WALL.
- 11. PATCH AND REPAIR EXISTING COLUMN WRAPS WHERE AFFECTED BY DEMOLITION. 12. PATCH AND REPAIR EXISTING WALLS WHERE AFFECTED BY DEMOLITION. 13. NOT USED
- 14. NOT USED
- 15. PROVIDE NEW SALVAGED LIGHT TO MATCH EXISTING LAYOUT. 16. GWB. VALANCE WITH LINEAR STRIP LIGHT. REFER TO FIXTURE SCHEDULE. REFER TO DETAIL
- 17. PROVIDE NEW LIGHTING TO MATCH EXISTING STOCK ROOM LIGHT
- FIXTURES. REFER TO FIXTURE SCHEDULE. 18. NEW GWB. CEILING SOFFIT AT FOCAL WALL. REFER TO DETAIL. 19. INFILL EXISTING CEILING GRID AND TILES AS REQUIRED TO MAINTAIN CONTINUOUS FIELD CEILING.
- 20. PROVIDE NEW MEZZANINE FRAMED PARTITION. REFER TO DETAIL 7/A101.2. mmmmm

City of Puyallup Development & Permitting Services ISSUED PERMIT Building Planning Engineering Public Works

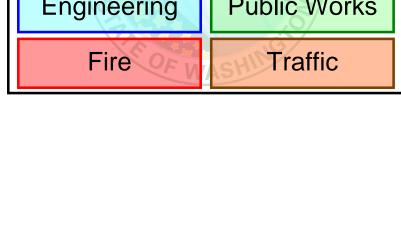

PROPOSED PROJECT LOCATION

484

PROPOSED PROJECT LOCATION

REYPLAN



STORE ENVIRONMENT Store Planning • Architecture Construction • Engineering 145 Progress Place Springdale, OH 45246




16 East 12th Street, Cincinnati OH 45202 (513) 549-6879 architecture359.com




	ENLARG PLANS A DETAIL	ND		
PROJE	CT INTERIOR ALTER TECT'S 202100475 CT NO.	RATIONS		
MACY'S SOUTH HILL MALL 3500 SOUTH MERIDIAN, SUITE 985 PUYALLUP, WA 98373				
C B A NO.	PLAN REVISION - FIELD CONDITION PLAN REVIEW BID AND PERMIT REVISIONS	0 03/07/2022 11/03/2022 9/28/2022 DATE		

A101.2

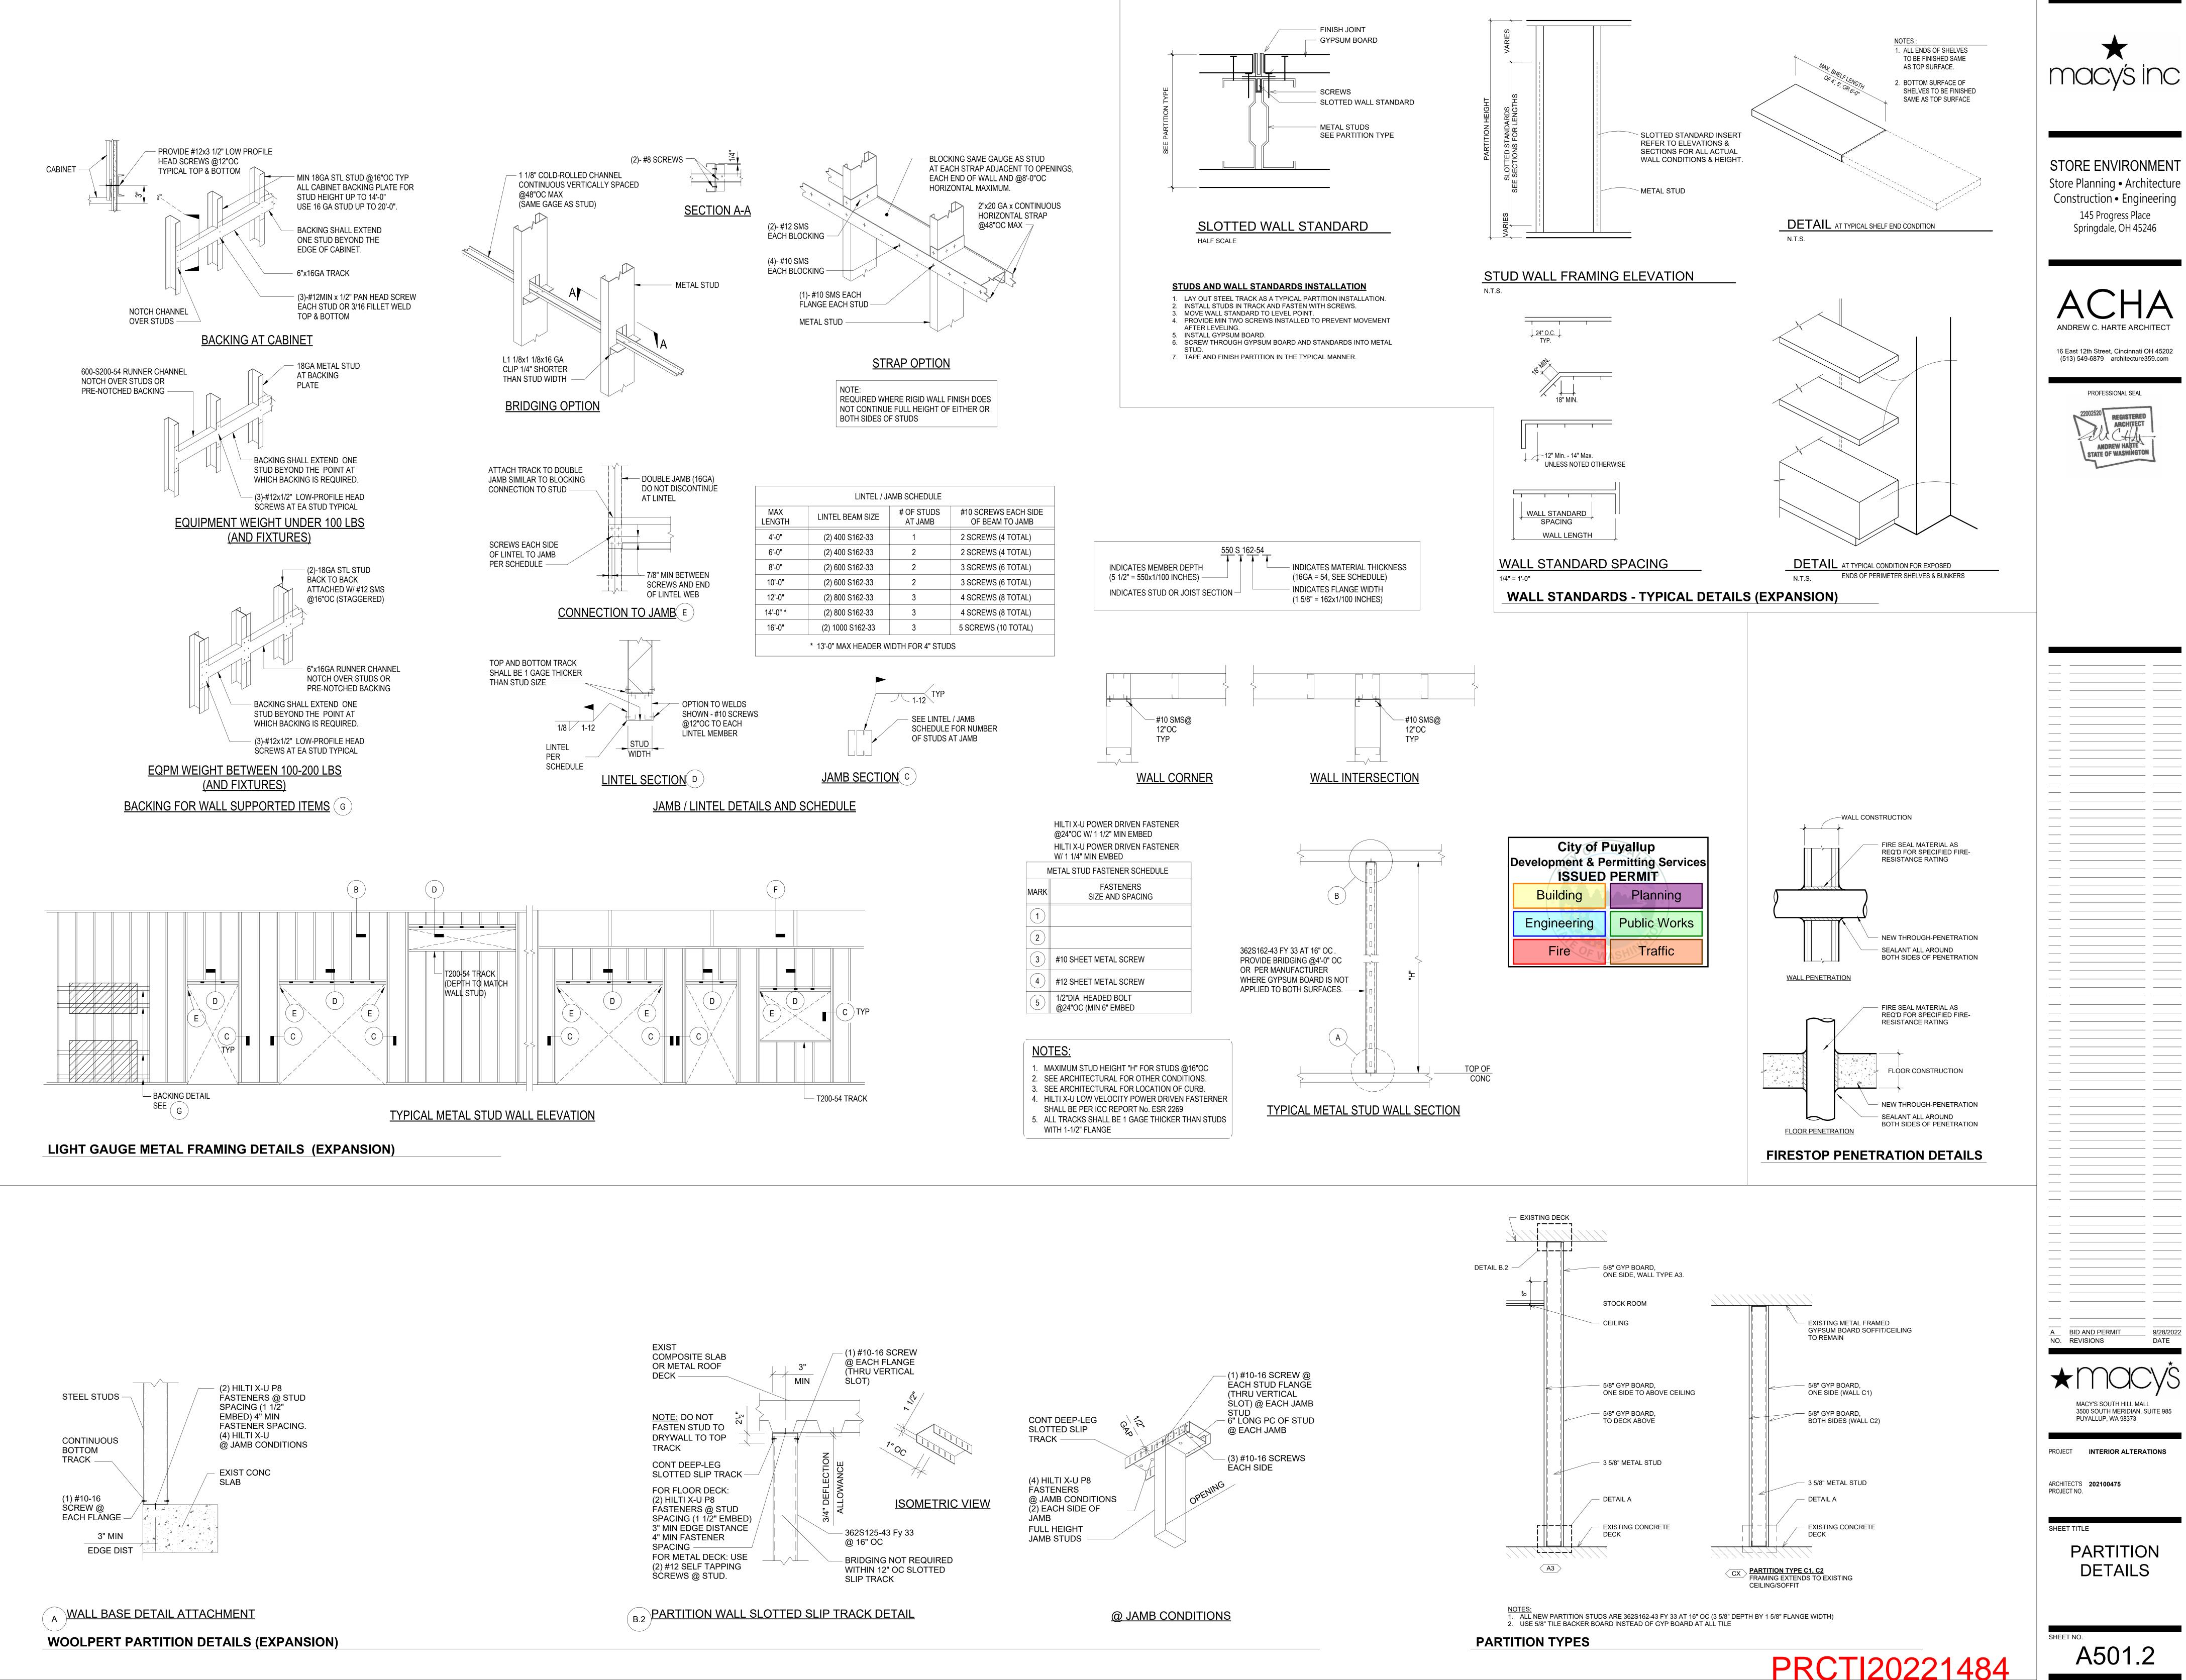

<u>9/28/2022</u>

DATE

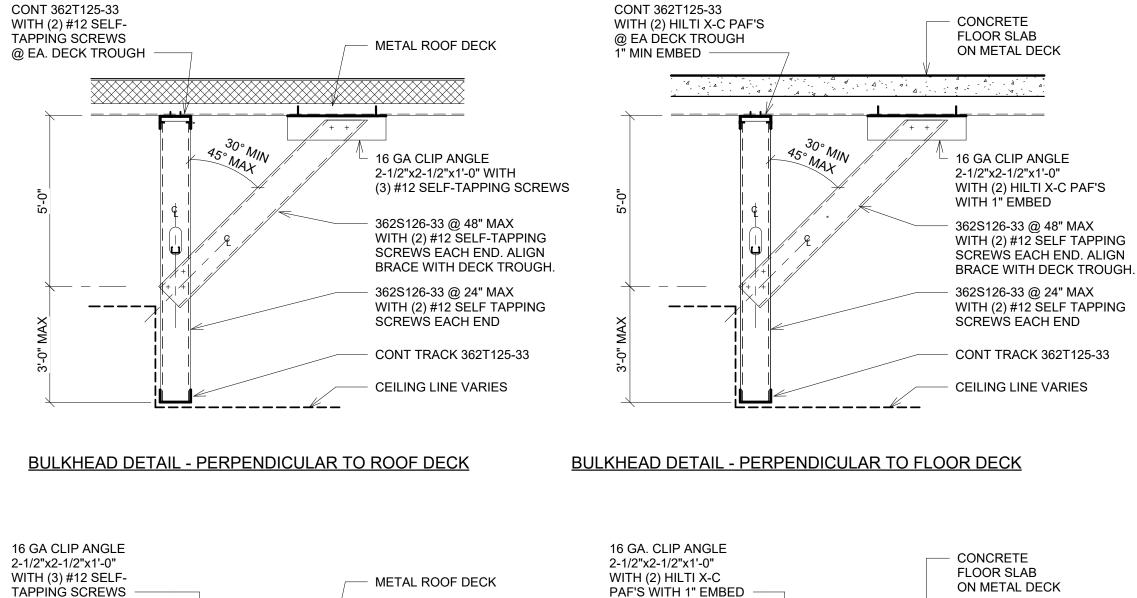

\_\_\_\_\_

-----,

BULKHEAD DETAIL - PARALLEL TO FLOOR DECK

4

16 GA CLIP ANGLE

WITH (2) HILTI X-C PAF'S

362S126-33 @ 48" MAX

SCREWS EACH END

SCREWS EACH END

— CEILING LINE VARIES

362S126-33 @ 24" MAX


CONT TRACK 362T125-33

WITH (2) #12 SELF TAPPING

WITH (2) #12 SELF TAPPING


2-1/2"x2-1/2"x1'-0"

WITH 1" EMBED

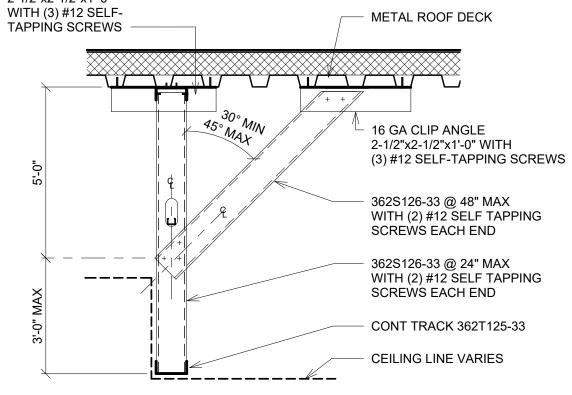

BULKHEAD DETAIL - PARALLEL TO ROOF DECK

C7 GYPSUM BOARD BULKHEAD - FRAMING DETAILS NO SCALE

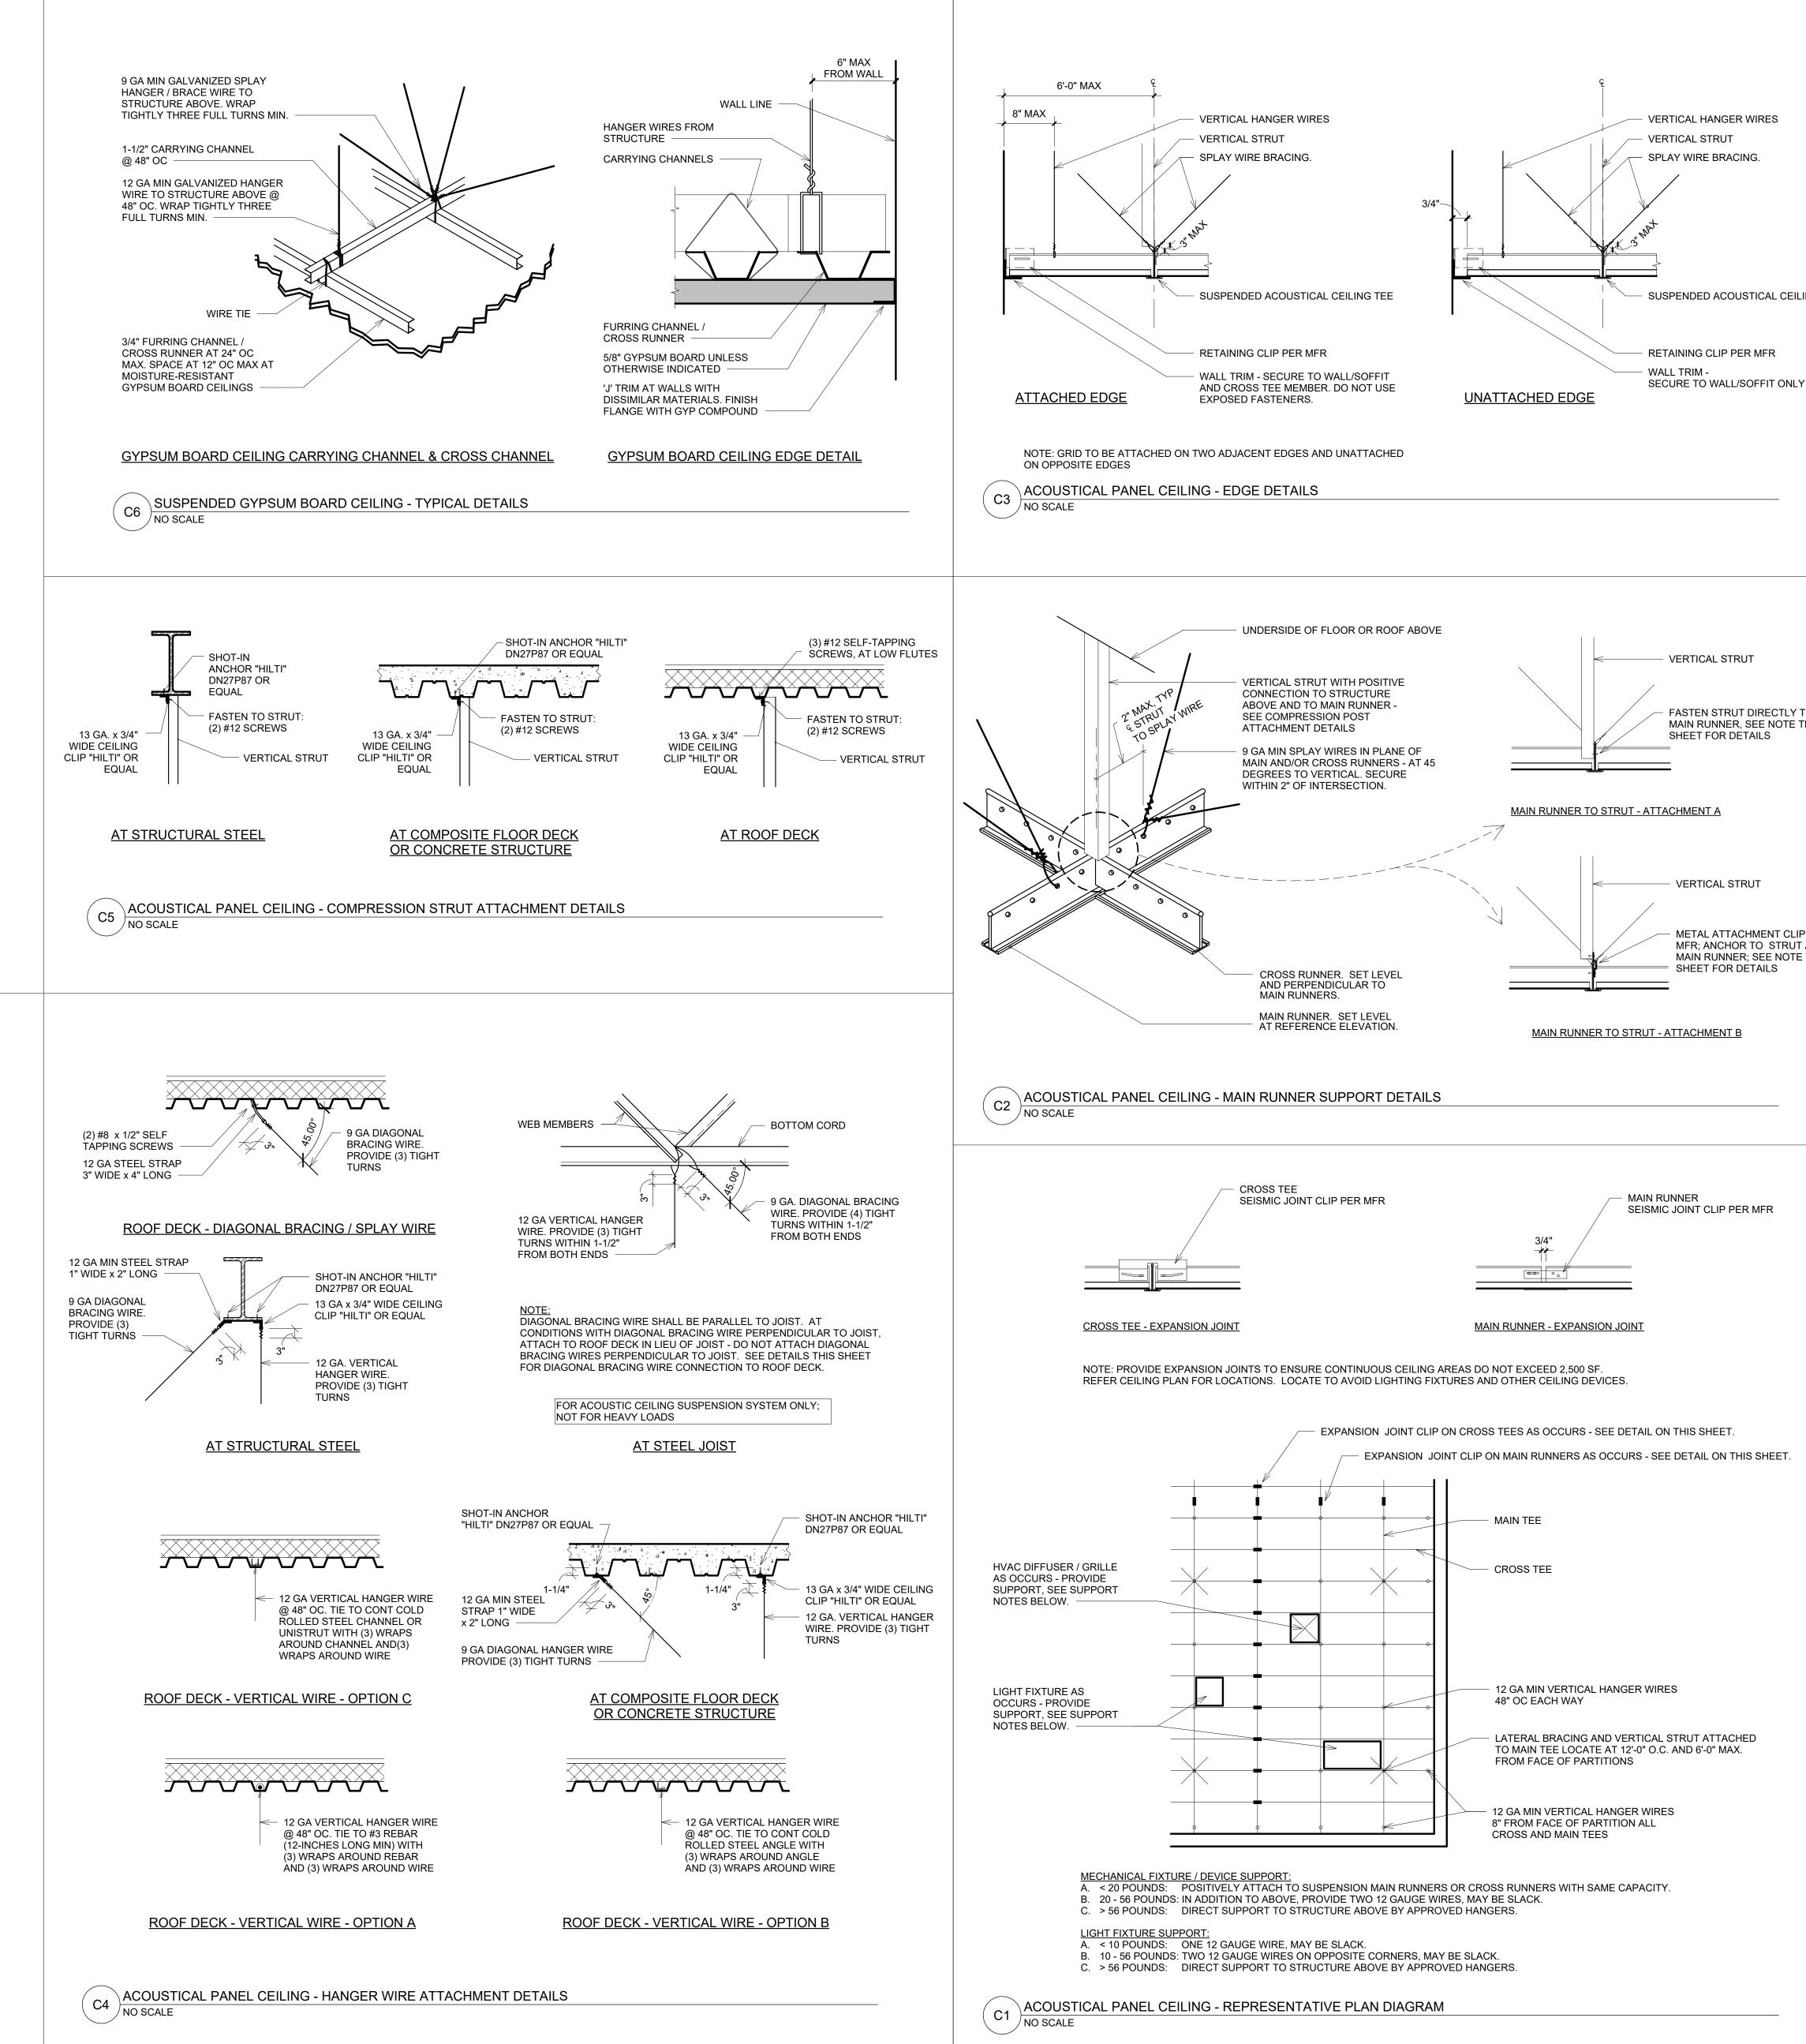


ING TEE	<ul> <li>DENERAL NOTES - CELLINGS</li> <li>DENERAL NOTES - ALL CELLING ASSEMBLIES</li> <li>A. REFER TO CELINGS AND INTERIOR SYSTEMS CONSTRUCTION ASSOCIATION (CA) "GUIDELINES FOR SEISMIC RESTRAINT FOR DIRECT HUNG SUSPENDED CELING ASSEMBLIES - SEISMIC ZONES 3-4. IS SPECIFIED IN THE INTERNATIONAL BUILDING CODE (IBC) EDITION FOR SEISMIC DESIGN CATEGORY D.E. AND F.</li> <li>DAUDING CODE (IBC) EDITION FOR SEISMIC DESIGN CATEGORY D.E. AND F.</li> <li>MEERE TO REPRESENTATIVE PLAN DIAGRAM ON THIS SHEET FOR TYPICAL ACOUSTICAL PANEL CELING CONDITIONS AND REQUIREMENTS. REFER TO INTERIOR DOCUMENTS FOR GRID SPACING, LAYOUT, TYPE, SIZE, ORIENTATION AND LOCATIONS.</li> <li>CONTRACTOR MUST PROVIDE SPECIFIED SUSPENSION SYSTEMS TO MEET STANDARDS AND REQUIREMENTS INDICATED IN THE CONTRACT DOCUMENTS. NO SUBSTITUTIONS PERMITTED UNLESS APPROVED IN WRITING BY STRUCTURAL LEGINEER OF RECORD OR ARCHITECT</li> <li>PARTITIONS THAT ARE TIED TO THE CELING AND ALL PARTITIONS GREATER THAN 6 FEET IN HEIGHT SHALL BE LATERALLY BRACED TO THE STRUCTURE. BRACING SHALL BE INDEPENDENT OF THE CELING SUSPENSION SYSTEM GRID" AND ALL CROSS TEES."</li> <li>ALL WIRE TIES ARE TO BE "HEAVY DUTY ACOUSTICAL CELING SUSPENSION SYSTEM GRID" AND ALL CROSS STEES."</li> <li>ALL MAIN BEAMS ARE TO BE "HEAVY DUTY ACOUSTICAL CELING SUSPENSION SYSTEM GRID" AND ALL CROSS TEES."</li> <li>ALL MAIN BEAMS ARE TO BE THREE TIGHT TURNS AROUND ITSELF WITHIN THREE INCHES, 12-GAUGE HANGER WIRE SPACED 4 FEET ON CENTER.</li> <li>CHANGES IN CELING PLANES REQUIRE POSITIVE BRACING.</li> <li>SEISMIC SPLAY WIRES SHALL BE FOUR 9-GAUGE WIRES ATTACHED TO THE MINES AND AND ALL CROSS TEES."</li> <li>ALL MIRE SHALL BE FASTENED WITHIN 2 INCHES OF THE CONNECTION OF AND AND ALL CROSS TEES TO DE THE CON CENTER (MAXIMUM) AND BEAM. WIRES ARA ARRAYED 90 DEGRES FROM EACH OTHER AND ATAN ANGLE NOT EXCELLING NOTES - LATERAL BEACING</li> <li>SEISMIC SPLAY WIRES SHALL BE FOUR 9-GAUGE WIRES ATTACHED TO THE MINES AND ALL SEATING TO SUSPENDED CELING.</li></ul>	<image/> <section-header><section-header><text><text></text></text></section-header></section-header>
TO THIS	<ul> <li><u>ACOUSTIC PANEL CEILING NOTES - SPREADER BARS</u></li> <li>A. TERMINAL ENDS OF MAIN RUNNERS AND CROSS MEMBERS SHALL BE TIED TOGETHER OR HAVE SOME OTHER APPROVED MEANS TO PREVENT THEIR SPREADING. STABILIZER BARS, CROSS TEES OR OTHER MEANS TO PREVENT SPREADING SHALL OCCUR WITHIN 8 INCHES OF EACH WALL.</li> <li>B. SPREADER BARS ARE NOT REQUIRED AT PERIMETERS WHERE RUNNERS ARE ATTACHED DIRECTLY TO CLOSURE ANGLES.</li> <li>C. SPREADER BARS ARE NOT REQUIRED IF A 90 DEGREE INTERSECTING CROSS OR MAIN IS WITHIN 8 INCHES OF THE PERIMETER WALL.</li> <li><u>ACOUSTIC PANEL CEILING NOTES - HANGER (SUSPENSION) WIRES</u></li> <li>A. HANGER AND PERIMETER WIRES MUST BE PLUMB WITHIN 1 AND 6 UNLESS (FIGURE 5A) COUNTER SLOPING WIRES ARE PROVIDED.</li> <li>B. HANGER WIRES SHALL BE 12 GAUGE AND SPACED 4-FEET ON CENTER OR 10 GAUGE AND SPACED 5-FEET ON CENTER.</li> <li>C. TERMINAL ENDS OF EACH MAIN BEAM AND CROSS TEE MUST BE SUPPORTED WITHIN 8-INCHES OF EACH WALL WITH A PERIMETER WIRE.</li> <li>D. WIRES SHALL NO ATTACH TO OR BEND AROUND INTERFERING MATERIAL OR EQUIPMENT.</li> </ul>	(513) 549-6879 architecture359.com
P PER AND THIS	<ul> <li>GYPSUM BOARD CELLINGS - GENERAL NOTES</li> <li>A. SPACE B-GAUGE MINIMUM WIRES AT 48 INCHES ON CENTER ALONG CARRYING CHANNEL ATAIN WITHIN 6 INCHES OF THE END OF CARRYING CHANNEL RUNS.</li> <li>B. INSTALL 1-12 INCH CARRYING CHANNELS AT 48 INCHES ON CENTER AND WITHING INCHES FROM WALL. PROVIDE 1 INCH CLEARANCE BETWEEN RUNRES AND ABUTTING WALLS AND DARTITIONS. AT SPLICES, OVERLAP ENDS 12 INCHES AND BECLIRE BACH END WITH THE WIRE.</li> <li>C. ERECT METAL FRAMING AT KIGHT ANGLE TO CARRYING CHANNELS. SPACE STUDS WITHING INCHES OF WALL. PROVIDE 1 INCH CLEARANCE BETWEEN RUNRER ENDS ABUTTING WALLS AND PARTITIONS. ATTACH STUDIS TO 1-1/2 INCH CARRYING CHANNELS WITH 12 GAUGE MINIMUM TIE WIRE SPACE ON THE OLD STOT FOLLOWS TO FUEL AND SCIENCELY WIRE THE EACH END WITH FOUR DOUBLE STRANDS OF THE WIRES SPACED ON HANGING POINTS OF GRID AND WITHIN 6 FEET OF WIRES SPACED ON HANGING POINTS OF GRID AND WITHIN 6 FEET OF WIRES SPACED ON HANGING A SPECURED.</li> <li>E. ANCHOR DRYWALL TO SUPPORTING HORIZONTAL STUDS WITH #8.11 MINIMUM SUELFTAPING DRYWALL SCREWS AT 12 INCHES ON CENTER AT BUTT JOINTS. LOCATE NO LESS THAN 38 INCH GNORE THAN 12 INCH FROM EDGE OF BOARD.</li> <li>F. REFER TO ELECTRICAL DOCUMENTS FOR INDEPENDENT SUSPENSION REGUMERMENTS FOR INDEPENDENT SUSPENSION REGUMERMENTS FOR INDEPENDENT SUSPENSION REGUMERMENTS FOR INDEPENDENT SUSPENSION STRUCTION.</li> <li>SLOTTED CHANNEL FRAMING: BASIS OF DESIGN: UNISTRUT. REFER TO DIVISION S SECTION YACUUSTICAL PANEL CELLINGS - SEISIMC' FOR ADDITIONAL DETALL. A. 13/16-INCHES (11/2010 MS 21/2010 MS 21/2010/2010 MS 21/2010 MS 21/2010 MS 21/2010 MS 21/2010 MS 21/2010</li></ul>	
	<ol> <li>DRIVE SCREW FASTENERS TO EXTEND THROUGH SHEET STEEL AND MAIN BEAM CONNECTION A MINIMUM OF 3 EXPOSED THREADS, TO PENETRATE INDIVIDUAL COMPONENTS WITHOUT CAUSING PERMANENT SEPARATION BETWEEN COMPONENTS.</li> </ol>	
	City of Puyallup         Development & Permitting Services         ISSUED PERMIT         Building       Planning         Engineering       Public Works         Fire       Traffic	B PLAN REVIEW   A BID AND PERMIT   9/28/2022   9/28/2022   9/28/2022   9/28/2022   9/28/2022   DATE   MACY'S SOUTH HILL MALL S00 SOUTH MERIDIAN, SUITE 985 DYALLUP, WA 98373 PROJECT INTERIOR ALTERATIONS ACHITECT'S 202100475 PROJECT NO. SHEET TITLE CEILING DEETAILS


SHEET NO.

PRCTI20221484

A502.2



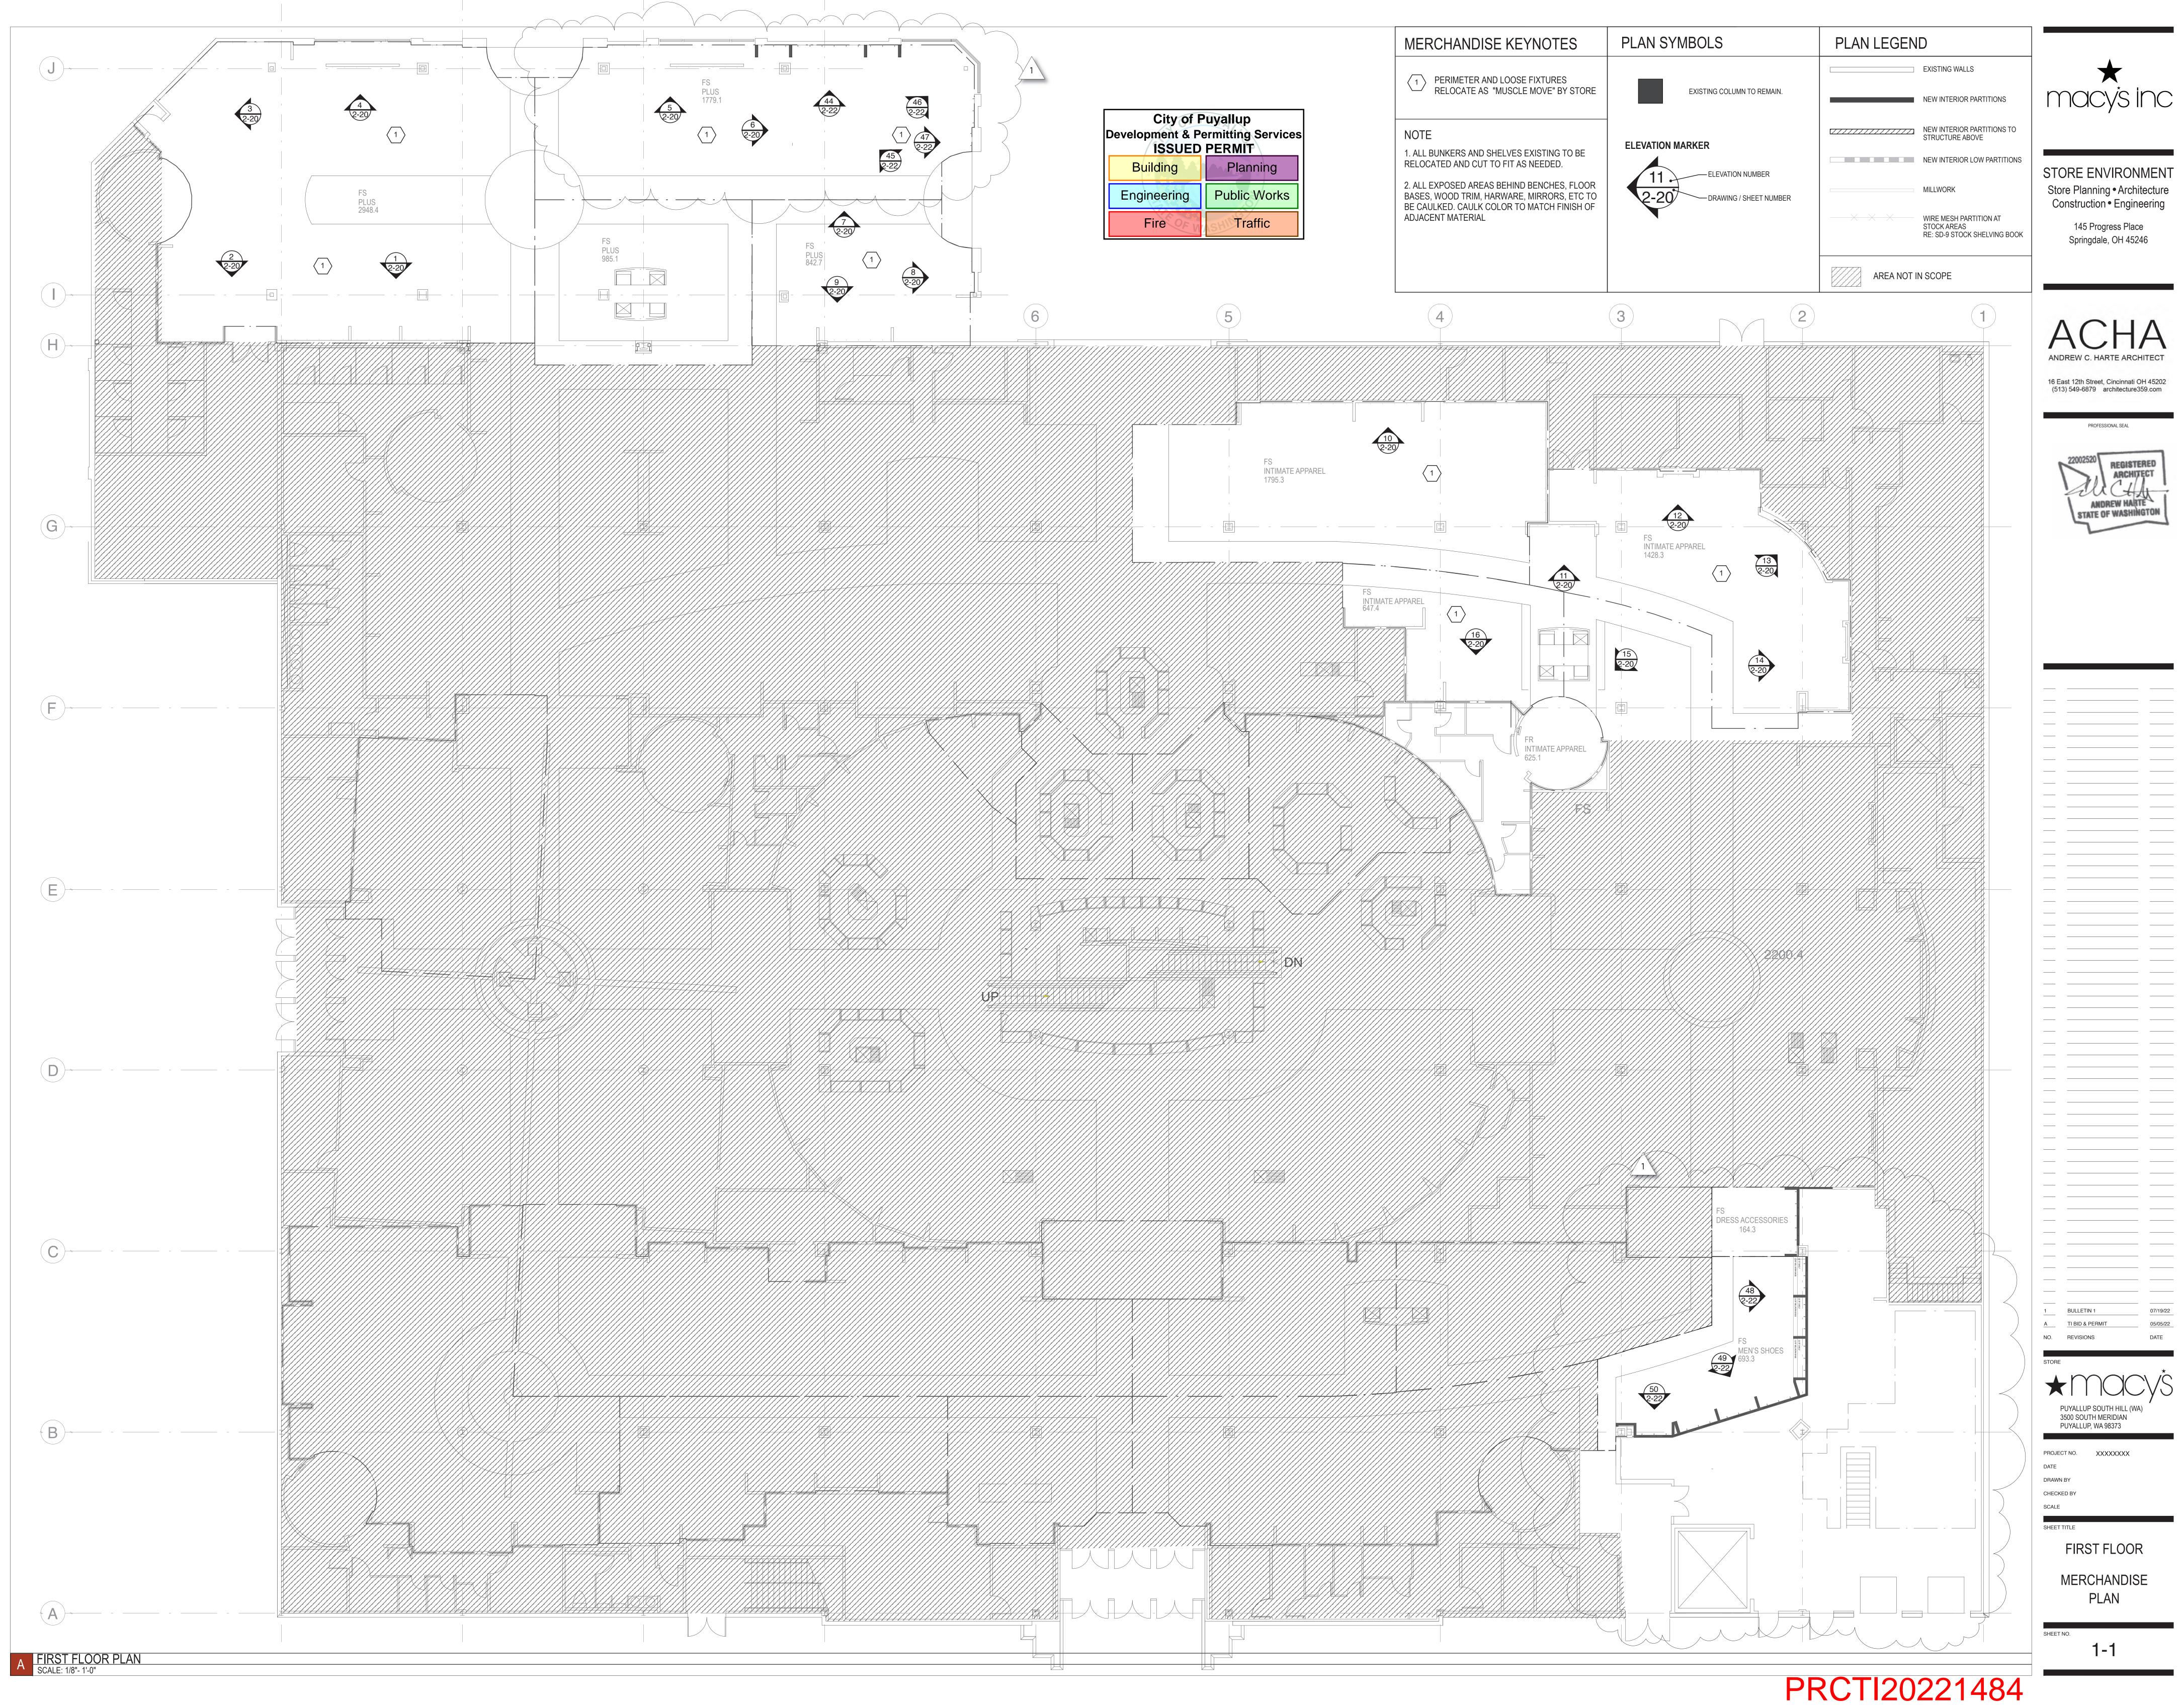

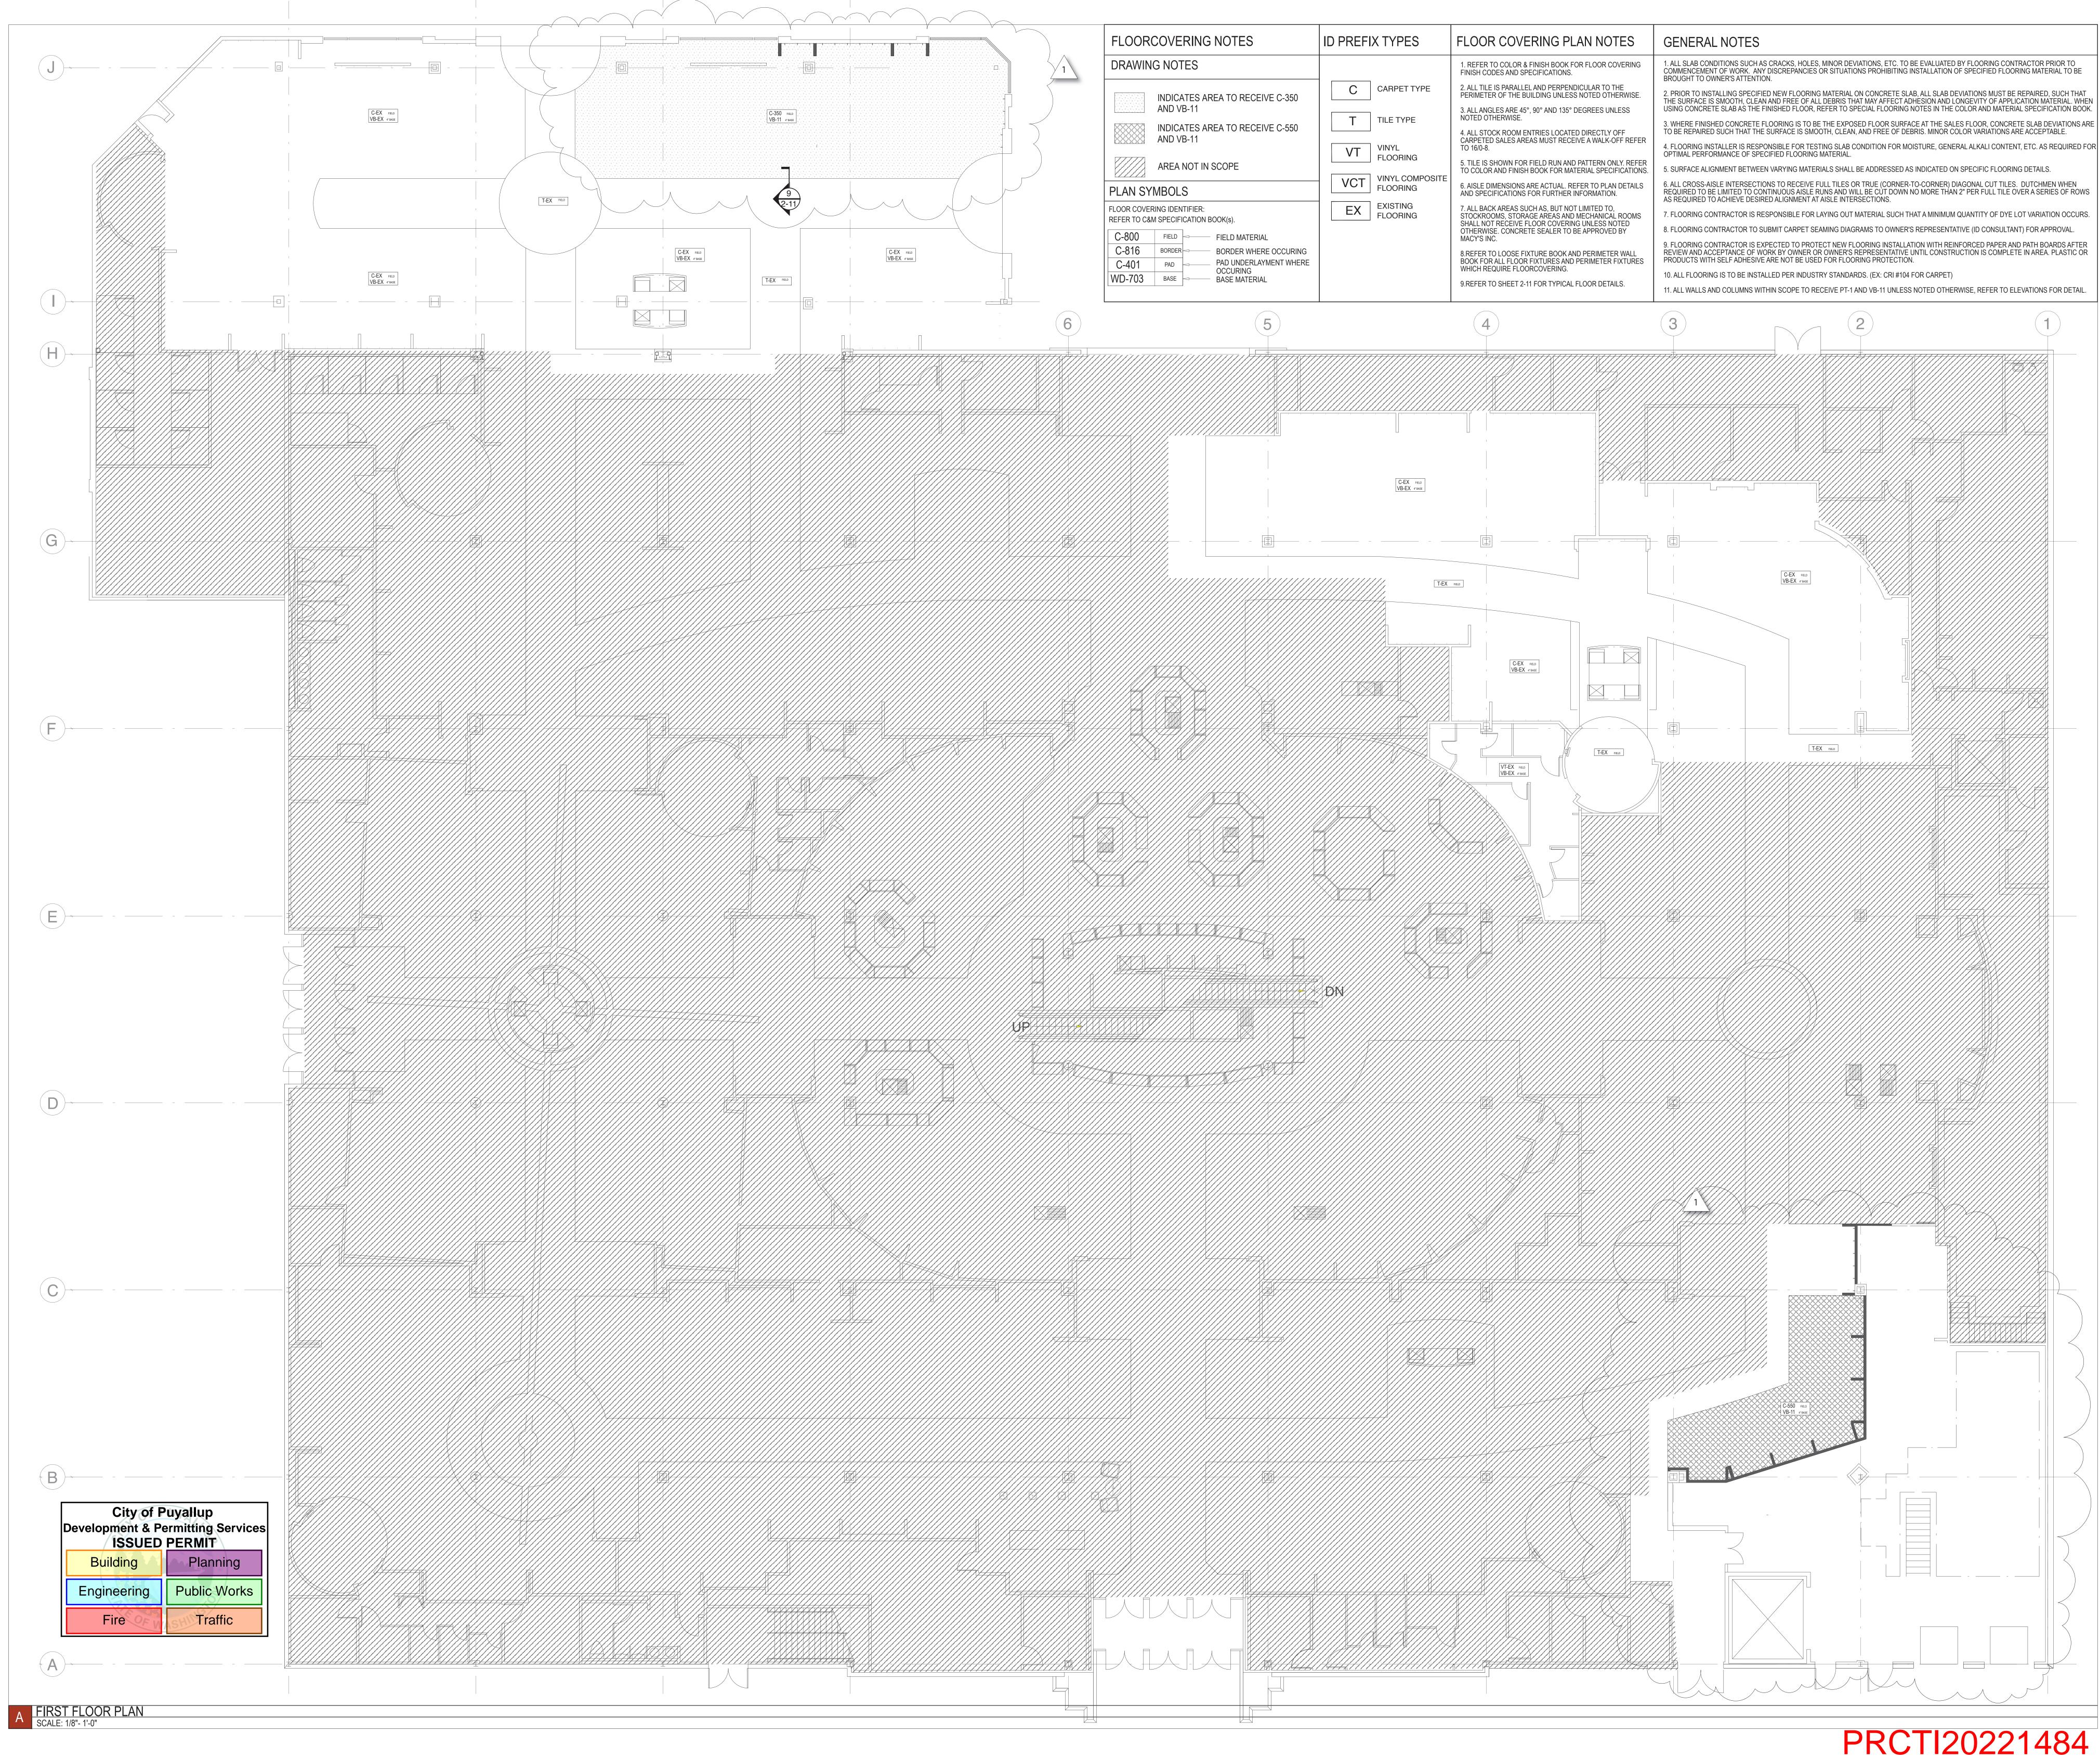




STORE ENVIRONMENT Store Planning • Architecture Construction • Engineering 145 Progress Place Springdale, OH 45246

ANDREW C. HARTE ARCHITECT

16 East 12th Street, Cincinnati OH 45202 (513) 549-6879 architecture359.com

PROFESSIONAL SEAL



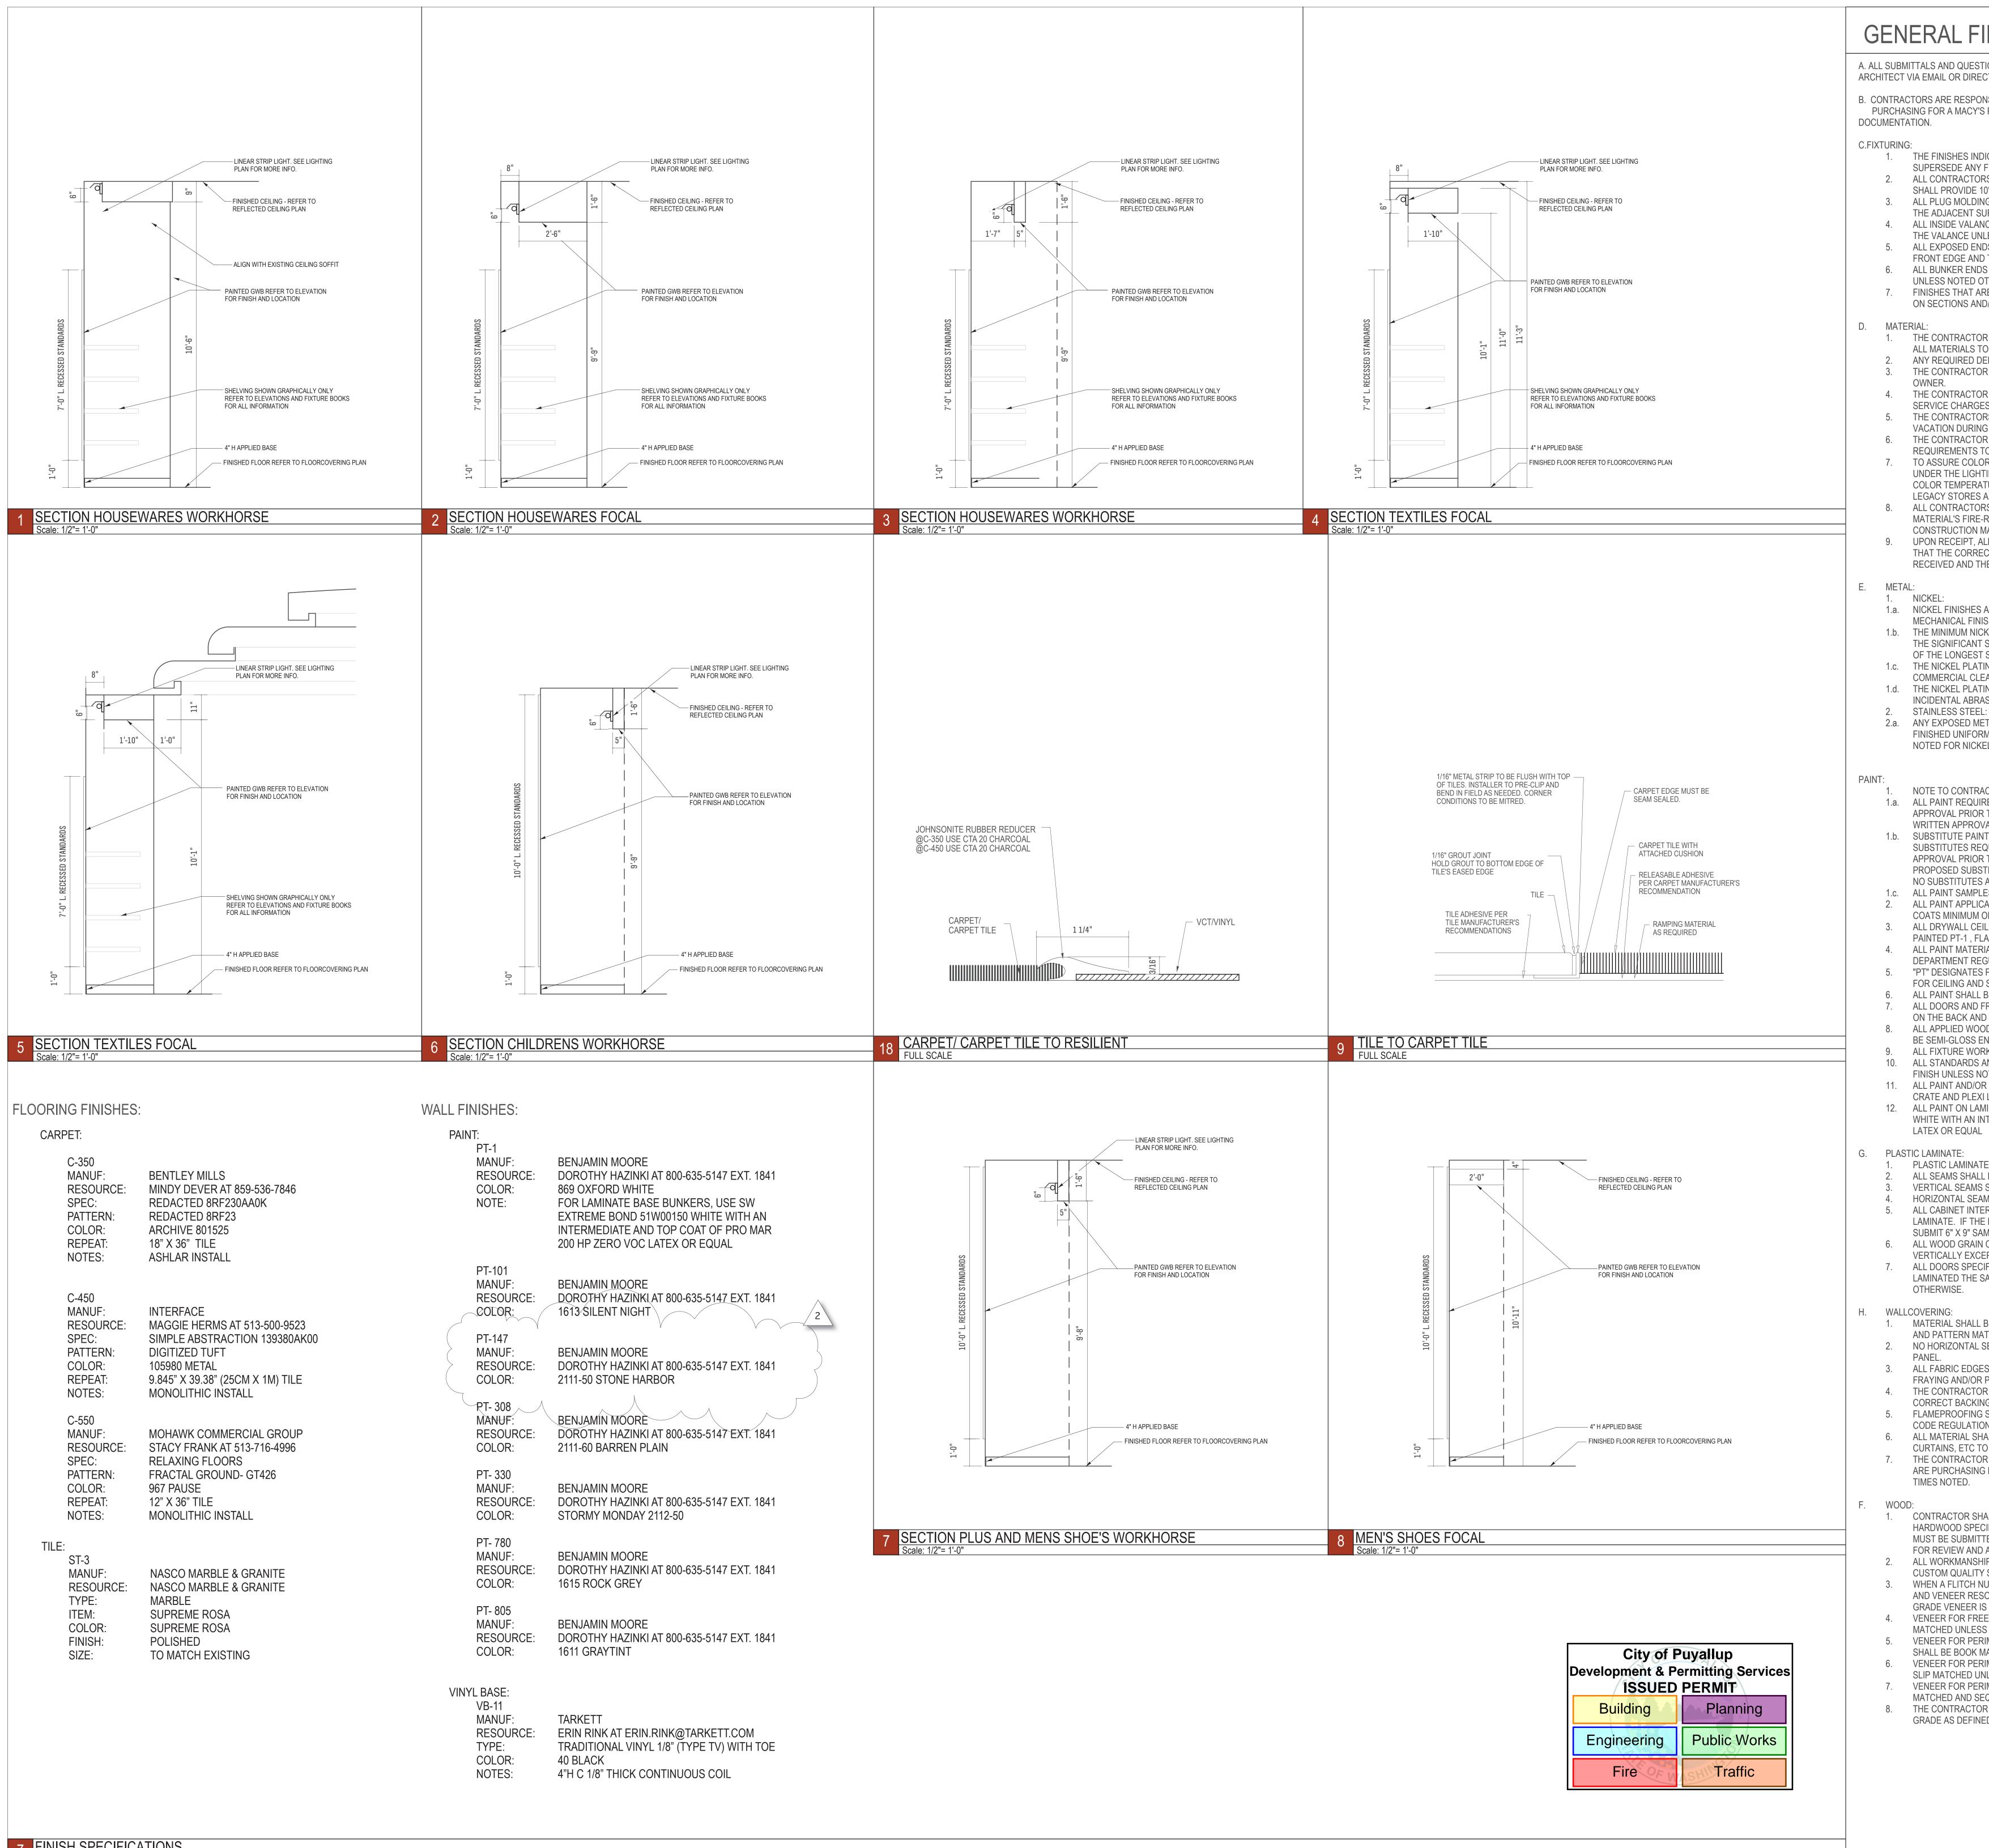

7 FINISH SPECIFICATIONS

## GENERAL FINISH NOTES

A. ALL SUBMITTALS AND QUESTIONS REGARDING FINISH SPECIFICATIONS SHALL BE DIRECTED TO THE ARCHITECT VIA EMAIL OR DIRECT SUBMISSION.

B. CONTRACTORS ARE RESPONSIBLE FOR NOTIFYING SPECIFIED RESOURCES THAT THEY ARE PURCHASING FOR A MACY'S PROJECT TO RECEIVE ANY PRICING OR LEAD TIMES NOTED WITHIN

> THE FINISHES INDICATED ON THE FIXTURE FINISH SCHEDULE OR AREA PLAN SHALL SUPERSEDE ANY FINISHES ON FIXTURE DETAIL DRAWINGS. ALL CONTRACTORS SUPPLYING NATURAL FINISH WOODWORK AND COLOR LACQUER SHALL PROVIDE 10" X 9" SAMPLES OF EACH FINISH TO THE ARCHITECT FOR APPROVAL ALL PLUG MOLDINGS IN FIXTURE WORK SHALL BE RECESSED AND PAINTED TO MATCH THE ADJACENT SURFACE.

ALL INSIDE VALANCE RETURNS SHALL BE FINISHED TO MATCH THE EXTERIOR FACE OF THE VALANCE UNLESS NOTED OTHERWISE ALL EXPOSED ENDS AND UNDERSIDES OF SHELVES SHALL BE FINISHED TO MATCH THE FRONT EDGE AND TOP UNLESS NOTED OTHERWISE ALL BUNKER ENDS SHALL BE FINISHED TO MATCH THE FRONT FACE OF THE BUNKER UNLESS NOTED OTHERWISE 7. FINISHES THAT ARE INDICATED ON ELEVATIONS SHALL SUPERSEDE ALL FINISHES NOTED ON SECTIONS AND/OR DETAIL DRAWINGS.

1. THE CONTRACTOR IS TO IMMEDIATELY PURCHASE FROM THE RESOURCES SPECIFIED ALL MATERIALS TO AVOID LEAD-TIME PROBLEMS. ANY REQUIRED DEPOSITS ARE THE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR MUST PROVIDE PROOF OF PURCHASE IF REQUESTED BY THE

THE CONTRACTOR IS RESPONSIBLE FOR ANY ADDITIONAL PURCHASE, SHIPPING OR SERVICE CHARGES FROM THEIR DELAY IN ORDERING MATERIALS. THE CONTRACTORS SHOULD NOTE THAT MANY MANUFACTURING FACILITIES CLOSE FOR ACATION DURING JULY OR AUGUST THE CONTRACTOR IS RESPONSIBLE FOR THE VERIFICATION OF FIREPROOFING

REQUIREMENTS TO MEET LOCAL CODE REGULATIONS. TO ASSURE COLOR CORRECTNESS, THE CONTRACTOR WILL MATCH ALL SAMPLES JNDER THE LIGHTING CONDITIONS OF THE STORE. MACY'S LEGACY STORES ARE COLOR TEMPERATURE 3000 K AND A COLOR RENDERING INDEX OF AT LEAST 80. MAY LEGACY STORES ARE A COLOR TEMPERATURE OF 3500 K. ALL CONTRACTORS ARE RESPONSIBLE FOR PROVIDING CERTIFICATES FOR ALL MATERIAL'S FIRE-RATINGS. CERTIFICATES ARE TO BE GIVEN TO THE MACY'S CONSTRUCTION MANAGER PRIOR TO THE INSTALLATION OF ANY MATERIAL UPON RECEIPT, ALL MATERIALS ARE TO BE CHECKED BY THE CONTRACTOR TO VERIFY THAT THE CORRECT COLOR, YARDAGE, BACKINGS, FLAME-PROOFING, ETC. HAVE BEEN RECEIVED AND THE MATERIALS ARE NOT DAMAGED.

1.a. NICKEL FINISHES ARE TO BE OBTAINED BY COMBINING ELECTROPLATING AND MECHANICAL FINISHING PROCESSES.

1.b. THE MINIMUM NICKEL THICKNESS ON ALL MILD STEEL PRODUCTS IS TO BE 0.8 MIL ON THE SIGNIFICANT SURFACE, WHICH IS CONSTITUTED BY THE LONGITUDINAL MID-POINT OF THE LONGEST SEGMENT OF POSTS, BRACKETS OR SPINDLES. 1.c. THE NICKEL PLATING MUST BE RESISTANT TO CORROSION AGAINST COMMON COMMERCIAL CLEANERS, ATMOSPHERIC MOISTURE AND HAND OILS. 1.d. THE NICKEL PLATING MUST BE WEAR RESISTANT AGAINST SLIDING HANGERS AND INCIDENTAL ABRASION.

ANY EXPOSED METAL WORK SPECIFIED TO BE SATIN STAINLESS STEEL IS TO BE FINISHED UNIFORMLY WITH 400 GRIT ABRASIVES. PERFORMANCE IS TO BE THE SAME AS NOTED FOR NICKEL FINISHES ABOVE.

### NOTE TO CONTRACTOR:

1.a. ALL PAINT REQUIRES A SAMPLE SUBMITTAL TO THE ARCHITECT / MACY'S DESIGN FOR APPROVAL PRIOR TO WORK COMMENCING. NO PAINT MAY BE APPLIED PRIOR TO WRITTEN APPROVAL

1.b. SUBSTITUTE PAINT MANUFACTURERS AND SPECIFICATIONS MAY BE CONSIDERED. ALL SUBSTITUTES REQUIRE SAMPLE SUBMITTAL TO THE ARCHITECT / MACY'S DESIGN FOR APPROVAL PRIOR TO WORK COMMENCING. EACH SAMPLE MUST INCLUDE THE PROPOSED SUBSTITUTE SIDE-BY-SIDE WITH THE SPECIFICATION LISTED ON THIS SHEET NO SUBSTITUTES ARE ALLOWED WITHOUT WRITTEN APPROVAL. 1.c. ALL PAINT SAMPLES MUST BE A MINIMUM 4" SQUARE.

ALL PAINT APPLICATIONS SHALL INCLUDE PRIMER TO COVER EXISTING FINISH AND (2) COATS MINIMUM OF INDICATED PAINT ALL DRYWALL CEILINGS AND ASSOCIATED FACES OF VERTICAL SOFFIT DROPS SHALL BE PAINTED PT-1, FLAT FINISH UNLESS NOTED OTHERWISE ALL PAINT MATERIALS SHALL BE FIRE-RETARDANT IN ACCORDANCE WITH LOCAL FIRE

DEPARTMENT REGULATIONS. "PT" DESIGNATES PAINT, EGGSHELL FINISH UNLESS NOTED OTHERWISE - SEE ABOVE FOR CEILING AND SOFFIT PAINT FINISH. ALL PAINT SHALL BE CARRIED BEHIND BUNKERS TO FINISHED FLOOR OR BASE.

ALL DOORS AND FRAMES ON THE SALES FLOOR SHALL BE PAINTED THE SAME COLOR ON THE BACK AND EDGES AS THE FRONT UNLESS NOTED OTHERWISE. ALL APPLIED WOOD BASES, DOORS, TRIMS, MOLDINGS AND FRAMED OPENINGS SHALL BE SEMI-GLOSS ENAMEL TO MATCH ADJACENT FINISHES UNLESS NOTED OTHERWISE. ALL FIXTURE WORK SHALL BE SATIN ENAMEL UNLESS NOTED OTHERWISE. ALL STANDARDS AND GRILLS SHALL BE PAINTED WITH ENAMEL TO MATCH ADJACENT FINISH UNLESS NOTED OTHERWISE. ALL PAINT AND/OR WALLCOVERING SHALL CONTINUE TO THE CEILING LINE WHEN EGG

CRATE AND PLEXI LENS DO NOT EXIST 12. ALL PAINT ON LAMINATE BUNKERS TO BE PRIMED WITH SW EXTREME BOND B51W00150 WHITE WITH AN INTERMEDIARE AND TOP COAT OF PROMAR 200 HP ZERO VOC INTERIOR LATEX OR EQUAL

PLASTIC LAMINATE SHALL BE USED IN MAXIMUM LENGTH PIECES TO ELIMINATE SEAMS. ALL SEAMS SHALL BE EVEN AND FLAT WHEN THEY ARE NECESSARY. VERTICAL SEAMS SHALL BE LOCATED AT RECESSED STANDARDS ONLY.

HORIZONTAL SEAMS SHOULD NOT BE REQUIRED. ALL CABINET INTERIORS SHALL BE MELAMINE TO MATCH THE EXTERIOR PLASTIC LAMINATE. IF THE MELAMINE COLOR IS NOT SPECIFIED, THE CONTRACTOR MUST SUBMIT 6" X 9" SAMPLES FOR APPROVAL. ALL WOOD GRAIN ON PERIMETER AND FREESTANDING FIXTURES SHALL RUN VERTICALLY EXCEPT AS NOTED OTHERWISE ON DRAWINGS. ALL DOORS SPECIFIED AS PLASTIC LAMINATE SHALL BE MATTE FINISH AND SHALL BE

LAMINATED THE SAME COLOR ON THE BACK AND EDGES AS THE FRONT UNLESS NOTED

1. MATERIAL SHALL BE SPACED BETWEEN STANDARDS SO THAT THERE ARE NO SEAMS AND PATTERN MATCH MUST BE PERFECT TO ADJACENT SIDES. 2. NO HORIZONTAL SEAMS ARE ACCEPTABLE. MATERIAL MUST BE A FULL DROP EACH

ALL FABRIC EDGES SHALL BE FINISHED CLEANLY AND PROPERLY ON THE WALL. NO FRAYING AND/OR PILLING IS ACCEPTABLE. 4. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL MATERIAL TAKE-OFFS AND THE CORRECT BACKING FOR EACH FABRIC TO USED AS WALLCOVERING. FLAMEPROOFING SHALL BE PROVIDED BY THE CONTRACTOR AS REQUIRED BY LOCAL CODE REGULATIONS. ALL MATERIAL SHALL CARRY BEHIND BUNKERS TO THE BASE AND BEHIND VALANCES, CURTAINS, ETC TO THE CEILING HEIGHT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR NOTIFYING THE RESOURCE THAT THEY ARE PURCHASING FOR A MACY'S INC PROJECT TO RECEIVE ANY PRICING AND LEAD

CONTRACTOR SHALL SUBMIT (4) 9" X 10" SAMPLES FOR EACH VENEER AND/OR HARDWOOD SPECIFIED FOR PROJECT. RELATED VENEER AND HARDWOOD SUBMITTALS MUST BE SUBMITTED TOGETHER. ALL SAMPLES SHALL BE ISSUED TO THE ARCHITECT FOR REVIEW AND APPROVAL. ALL WORKMANSHIP MUST COMPLY WITH THE ARCHITECTURAL WOODWORK INSTITUTE CUSTOM QUALITY STANDARDS. WHEN A FLITCH NUMBER IS PROVIDED, VENEER MUST BE ORDERED BY FLITCH NUMBER

AND VENEER RESOURCE AS SPECIFIED. IF A FLITCH NUMBER IS NOT PROVIDED, A+ GRADE VENEER IS REQUIRED. VENEER FOR FREE-STANDING FIXTURES IS TO BE SLIP MATCHED AND SEQUENCE MATCHED UNLESS NOTED OTHERWISE

VENEER FOR PERIMETER APPLICATIONS AND DESIGNATED AS FLAT-CUT OR FLAT-SAWN SHALL BE BOOK MATCHED UNLESS NOTED OTHERWISE. VENEER FOR PERIMETER APPLICATIONS AND DESIGNATED AS QUARTER CUT SHALL BE SLIP MATCHED UNLESS NOTED OTHERWISE. VENEER FOR PERIMETER AND PANEL APPLICATIONS SHALL BE BOOK MATCHED, CENTER MATCHED AND SEQUENCE MATCHED. THE CONTRACTOR IS REQUIRED TO FOLLOW THE TR-4 CONVERSION VARNISH PREMIUM GRADE AS DEFINED BY AWI, 7TH EDITION, SECTION 1500.



STORE ENVIRONMENT Store Planning • Architecture Construction • Engineering 145 Progress Place

Springdale, OH 45246



16 East 12th Street, Cincinnati OH 45202 (513) 549-6879 architecture359.com



2	BULLETIN 2	09/21/22
21	BULLETIN 1	09/21/22
A	TI BID & PERMIT	05/5/22
NO.	REVISIONS	DATE



DATE DRAWN BY

PROJECT NO. XXXXXXXX

SCALE SHEET TITLE


SHEET NO.


CHECKED BY

SECTIONS, DETAILS & FINISH **SPECIFICATIONS** 

2-11

# **PRCTI20221484**

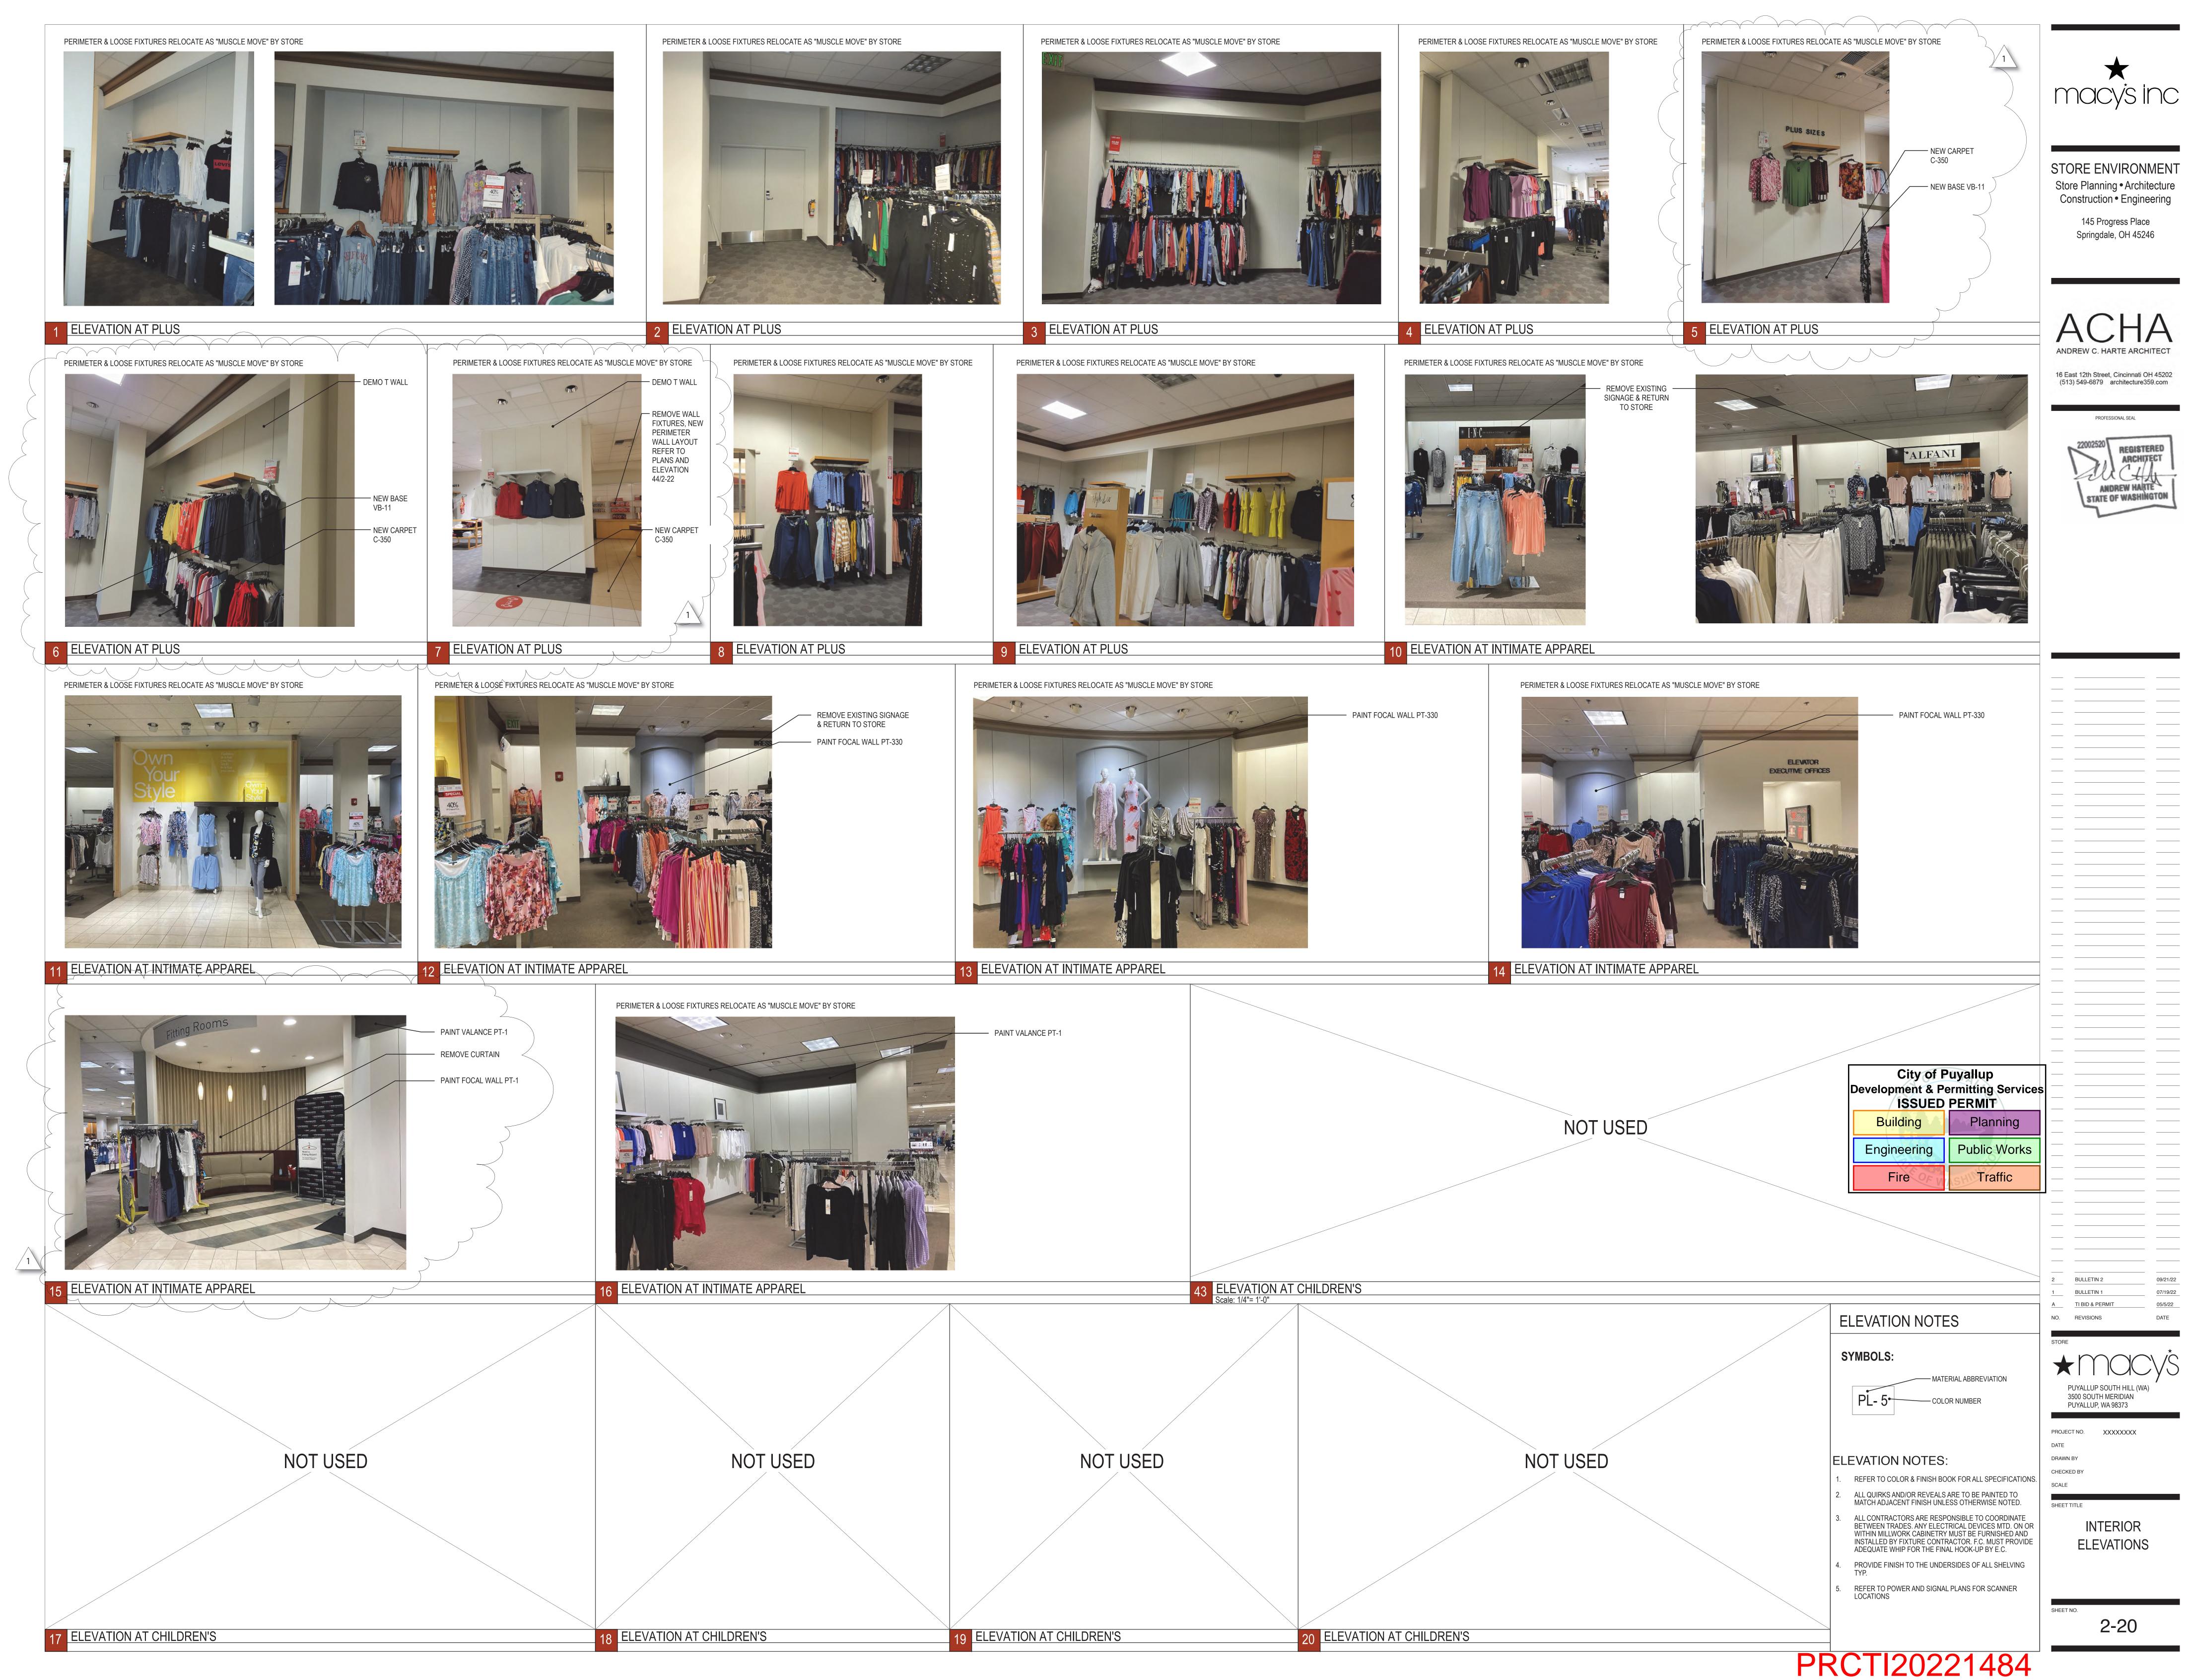


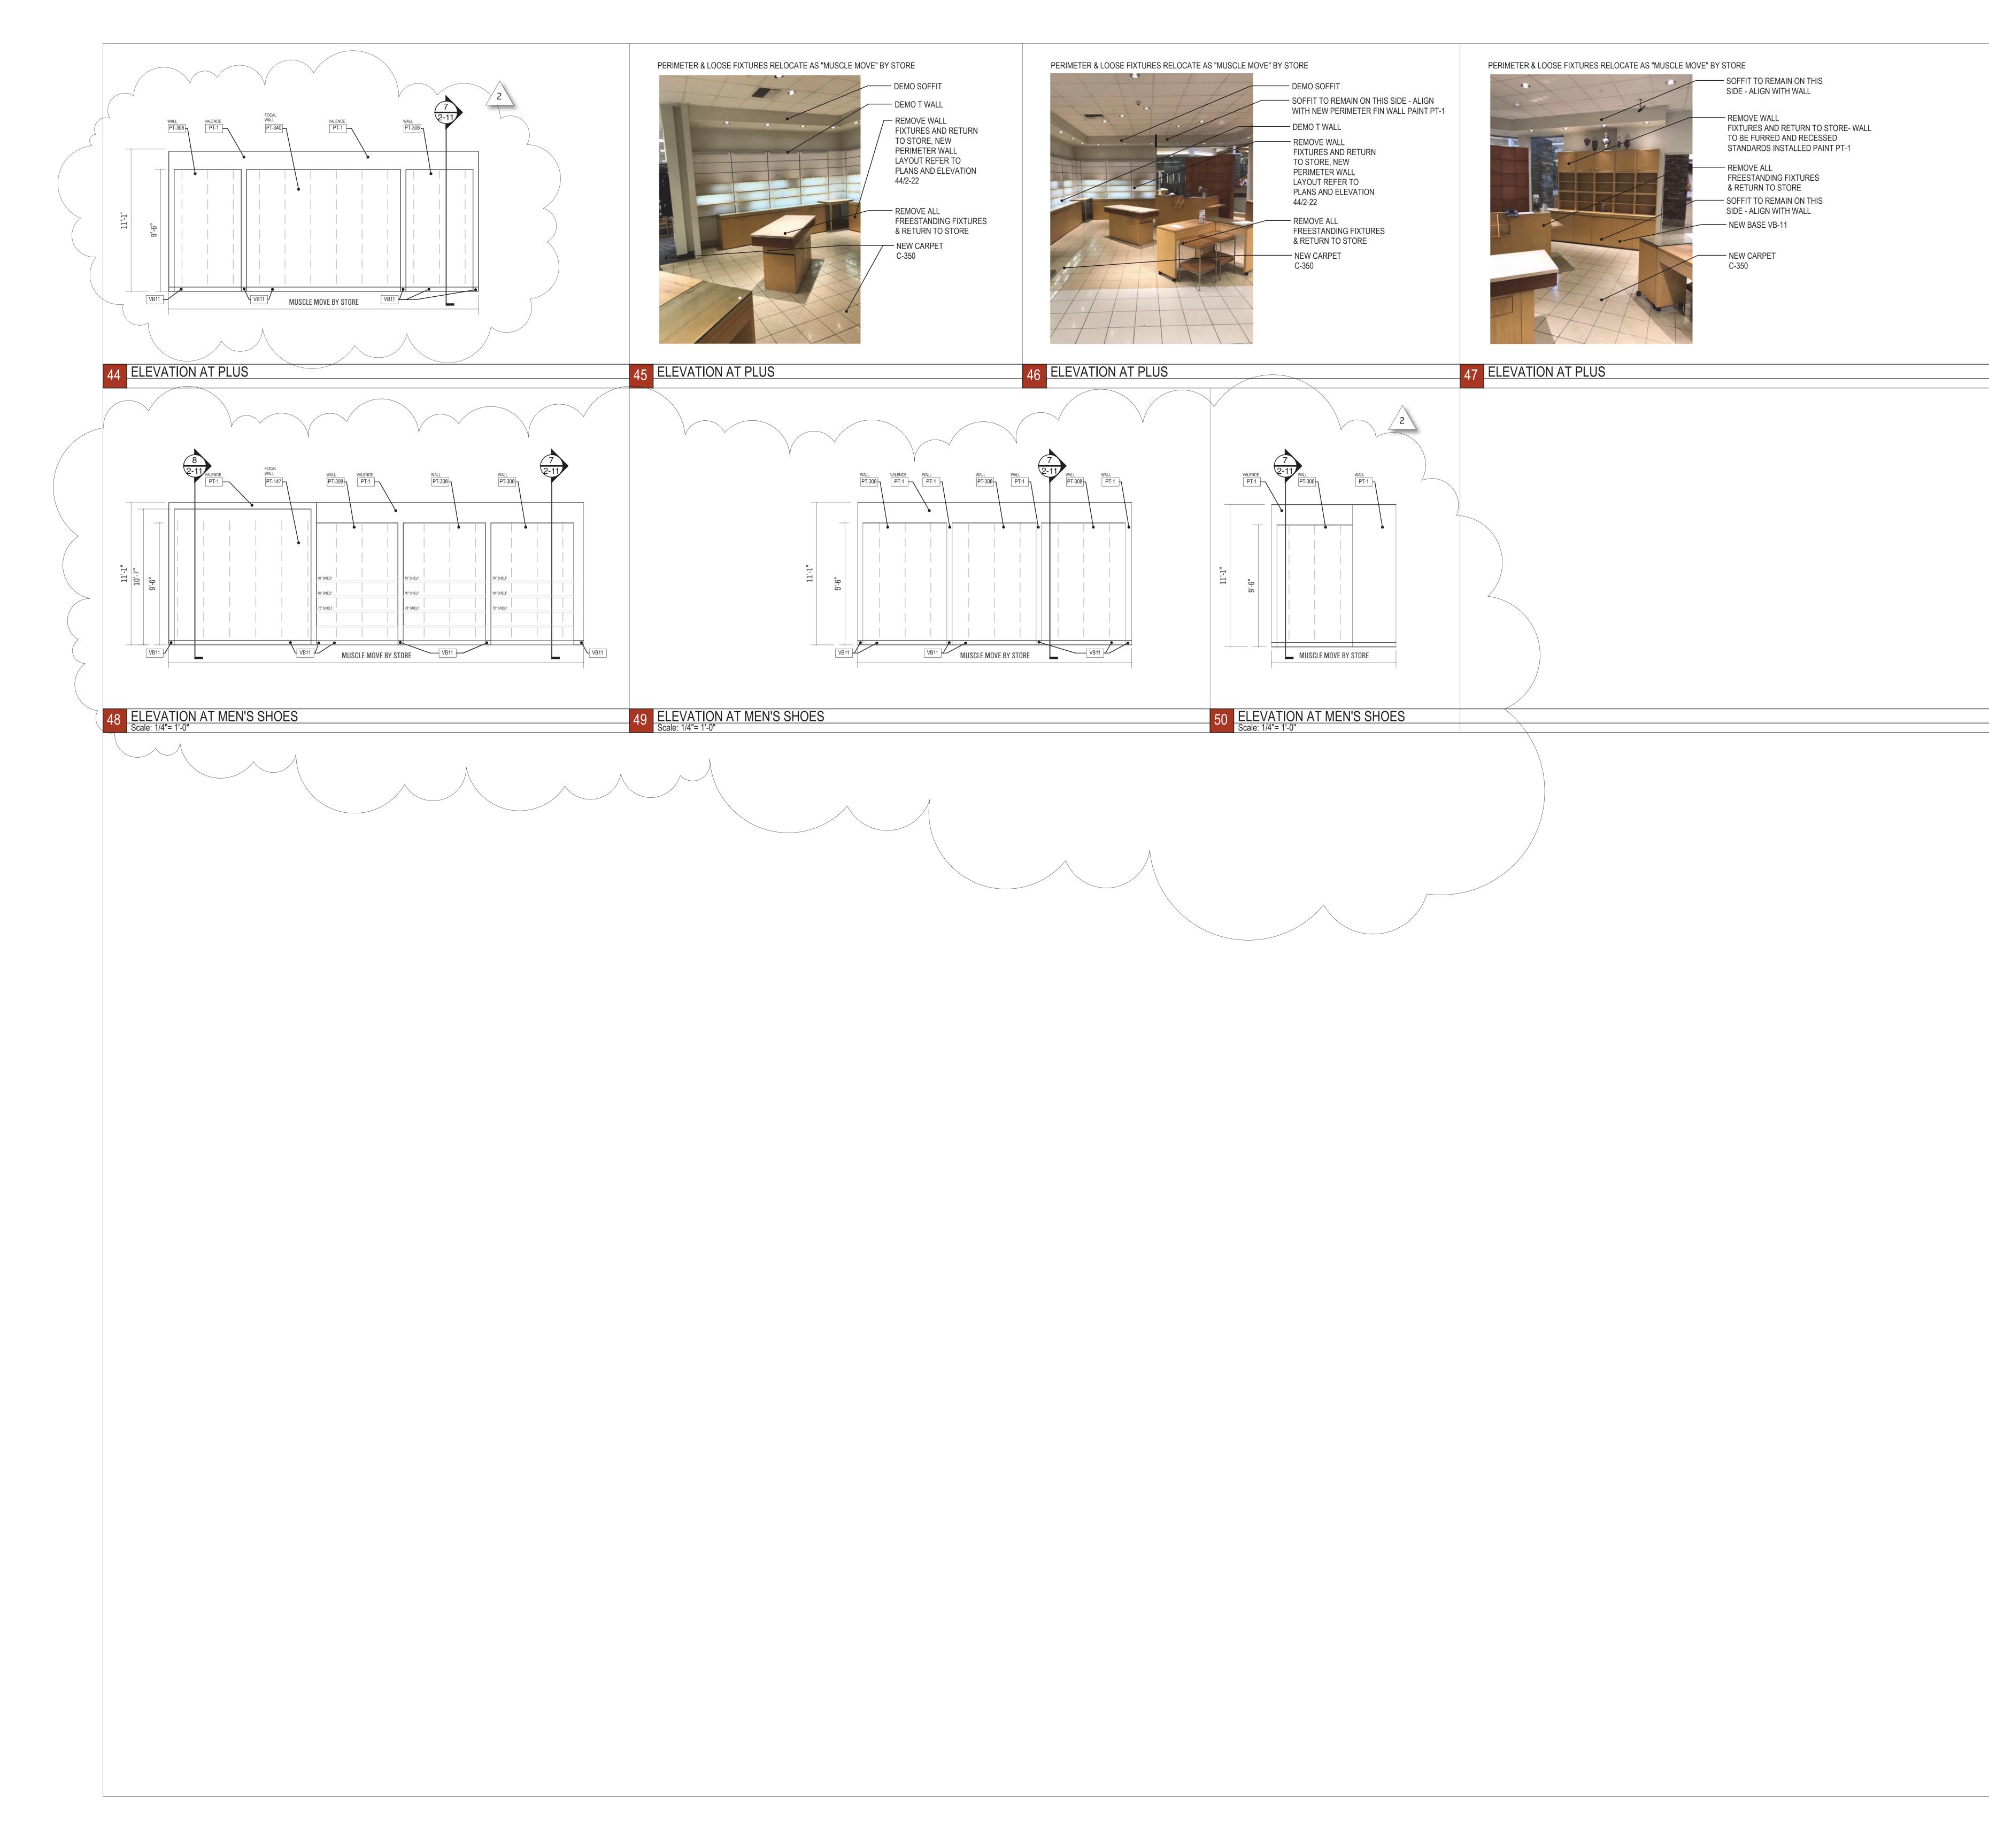



City of Puyallup Development & Permitting Services ISSUED PERMIT			
Building	Planning		
Engineering	Public Works		
Fire			

2	BULLETIN 2	09/21/22
  1	BULLETIN 2 BULLETIN 1	09/21/22
1	BULLETIN 1	07/19/22
1 A	BULLETIN 1 TI BID & PERMIT	07/19/22 05/5/22
1 A	BULLETIN 1 TI BID & PERMIT	07/19/22 05/5/22
1 A NO.	BULLETIN 1 TI BID & PERMIT	07/19/22 05/5/22
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS	07/19/22 05/5/22
1 A NO.	BULLETIN 1 TI BID & PERMIT REVISIONS	07/19/22 05/5/22
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 <u>TI BID &amp; PERMIT</u> REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 <u>TI BID &amp; PERMIT</u> REVISIONS PUYALLUP SOUTH HILL (WA)	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 <u>TI BID &amp; PERMIT</u> REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 <u>TI BID &amp; PERMIT</u> REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 <u>TI BID &amp; PERMIT</u> REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXX	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXXX NBY	07/19/22 05/5/22 DATE
1 A NO. STORE STORE PROJEC DATE DRAWN CHECK	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXXX NBY	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXXX NBY	07/19/22 05/5/22 DATE
1 A NO. STORE STORE PROJEC DATE DRAWN CHECK	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXX NBY ED BY	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXX NBY ED BY	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXXX I BY ED BY TITLE	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXX NBY ED BY TITLE INTERIOR	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXXX I BY ED BY TITLE	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXX NBY ED BY TITLE INTERIOR	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXX NBY ED BY TITLE INTERIOR	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXX NBY ED BY TITLE INTERIOR	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXX NBY ED BY TITLE INTERIOR	07/19/22 05/5/22 DATE
1 A NO. STORE STORE DROJEC DATE DRAWN CHECK SCALE SHEET	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXX I BY ED BY TITLE INTERIOR ELEVATIONS	07/19/22 05/5/22 DATE
1 A NO. STORE	BULLETIN 1 TI BID & PERMIT REVISIONS PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373 CT NO. XXXXXXX I BY ED BY TITLE INTERIOR ELEVATIONS	07/19/22 05/5/22 DATE





ANDREW C. HARTE ARCHITECT

16 East 12th Street, Cincinnati OH 45202 (513) 549-6879 architecture359.com





STORE ENVIRONMENT

Store Planning • Architecture Construction • Engineering

145 Progress Place




Room Name	
Dock Area	W
System Totals:	
	_
(Zpz) - Critical Space O.A. Fraction (Ev) - System Ventilation Efficiency (Table 6.2.5.2)	-
(Ev) - System Ventilation Efficiency (Paper dis. 2.5.2)	-
Peak People (SUM of Pz)	
System People	
(D) - Diversity	
(Vou) - Uncorrected Outdoor Air Intake	
(Xs) - Average Outdoor Air Fraction	
(Vot) - Outdoor Air Required	
Outdoor Air Provided	
Outdoor Air CFM Per Square Foot	
Outdoor Air % @ Ventilation Design	


-10"ø ---+----5 UH-1 / ====  $\sqrt{1}$ \_\_\_\_\_ 

(B)----

PARTIAL 1ST FLOOR HVAC DEMOLITION PLAN SCALE: 1/8"=1'-0"

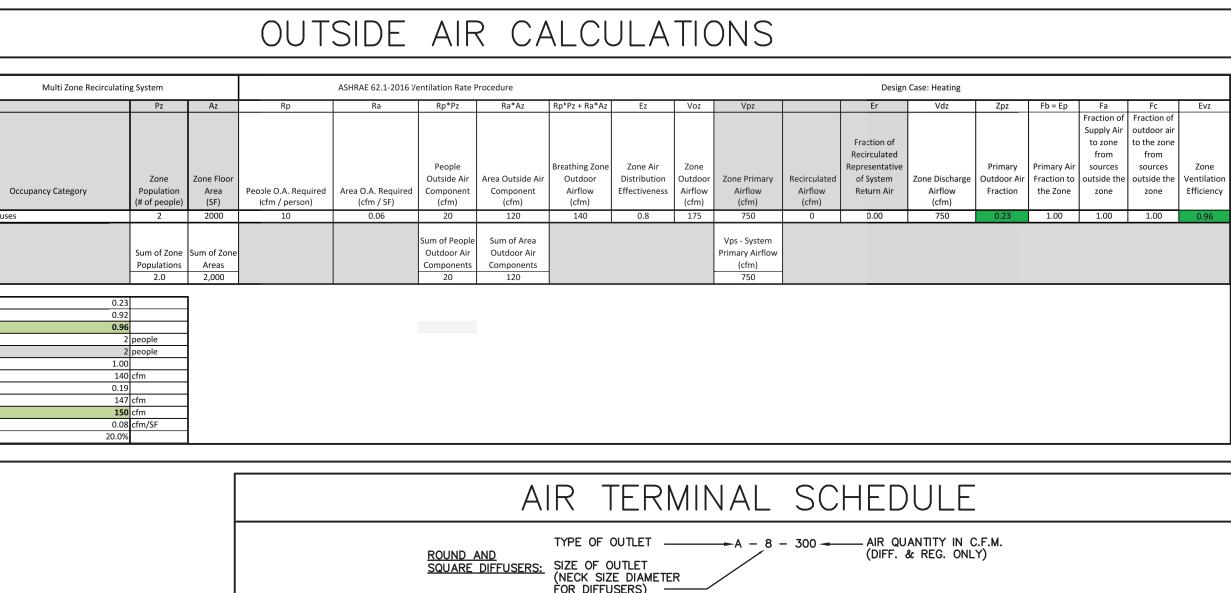


FOR DIFFUSERS)			
TYPE	DESCRIPTION		
A	STEEL RECTANGULAR LOUVERED SUPPLY AIR GRILLE. ADJUSTABLE DOUBLE DEFLECTION, 3/4" BLADE SPACING, 18"x8" UNLESS NOTED OTHERWISE. TITUS MODEL 300RL OR EQUAL.		
В			

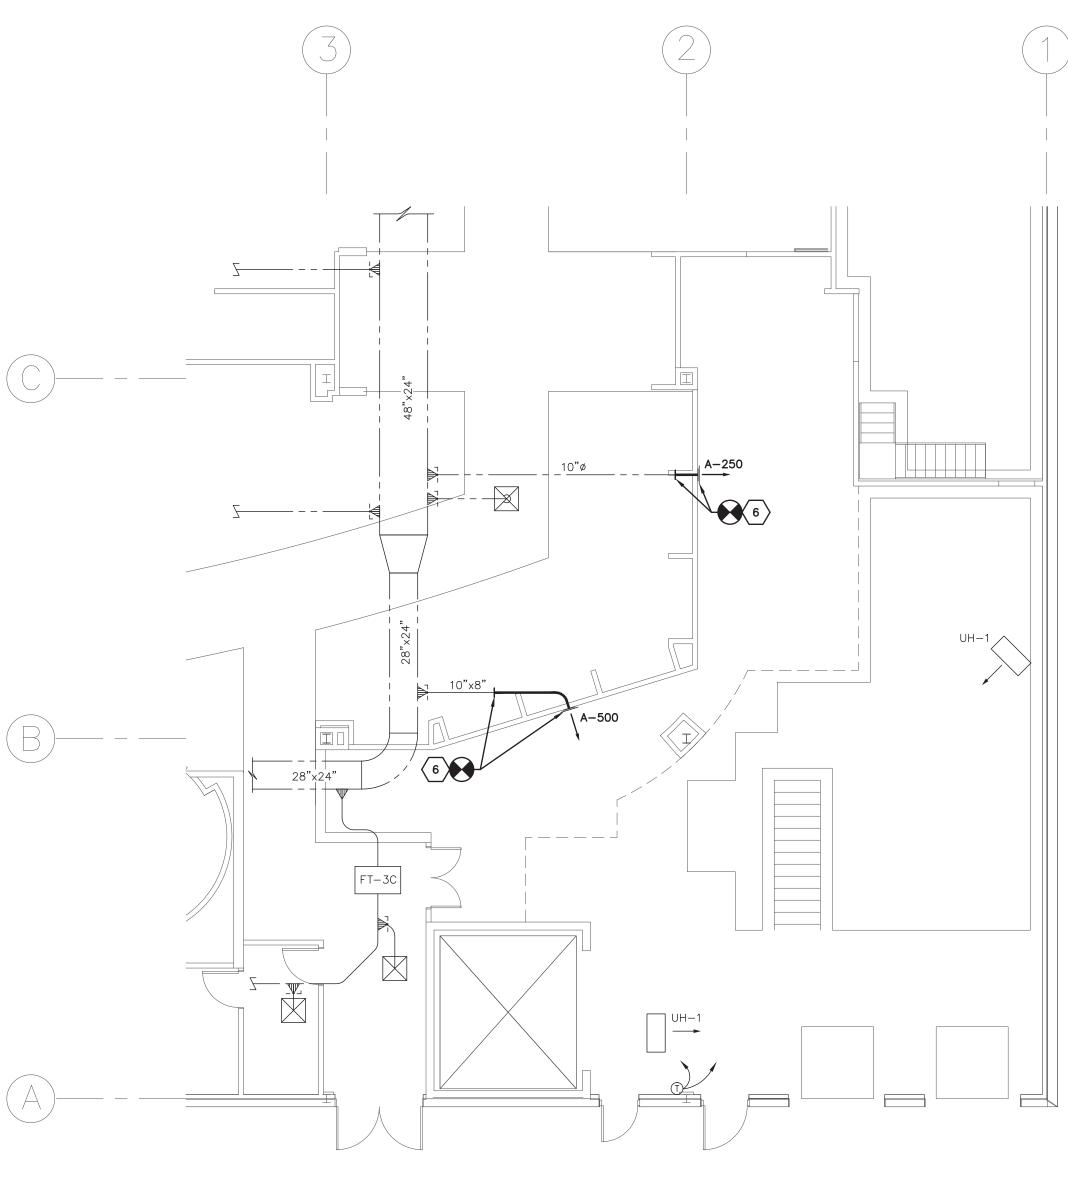

City of P Development & Pe ISSUED	ermitting
Building	Plar
Engineering	Public
Fire OF W	SHITTE



PARTIAL 1ST FLOOR HVAC PLAN scale: 1/8"=1'-0"

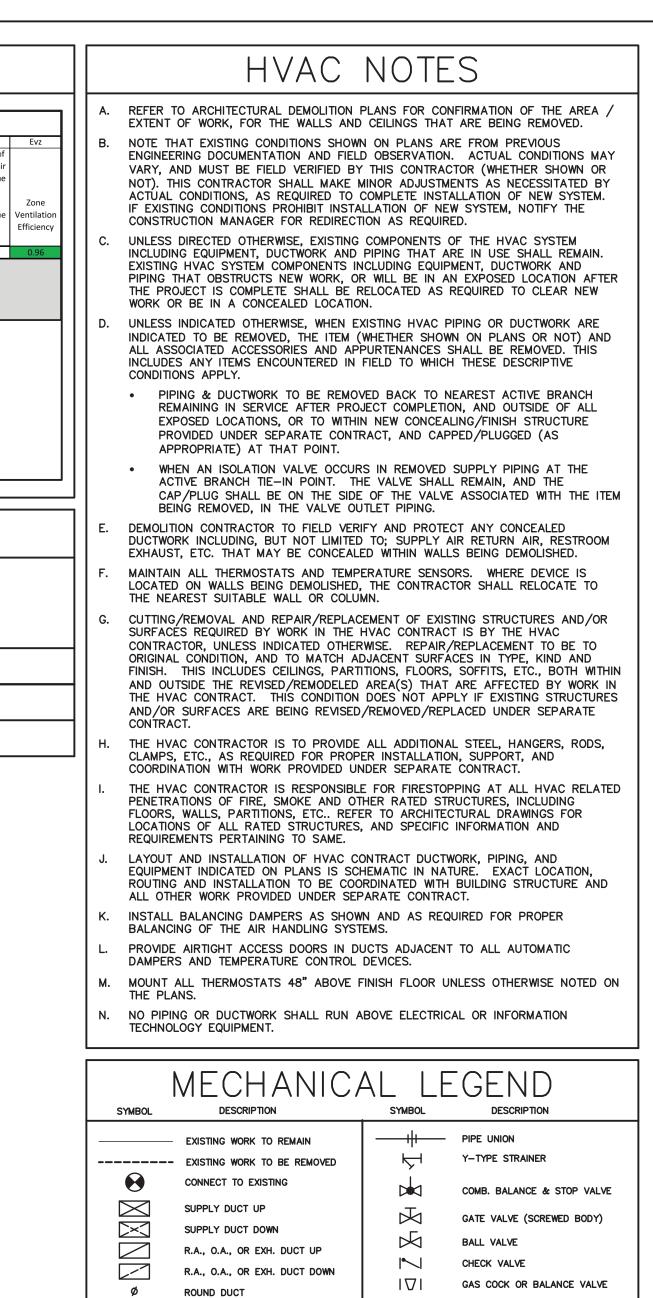

**₽**₩

Ξ÷

T

ELBOW WITH TURNING VANES

DAMPER


SPIN-IN FITTING WITH BALANCE DAMPER


45° BOOT BRANCH TAKEOFF

THERMOSTAT

FLOOR OR AREA DRAIN


THRU FLOOR AS SHOWN

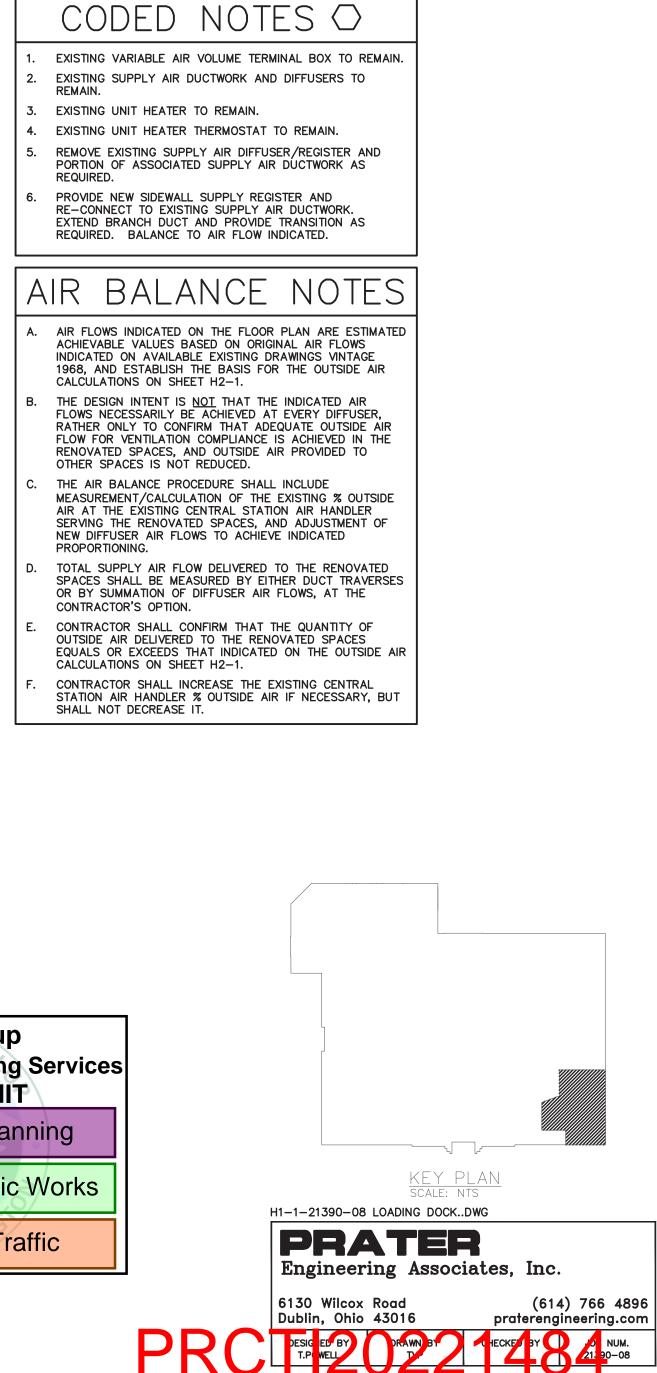

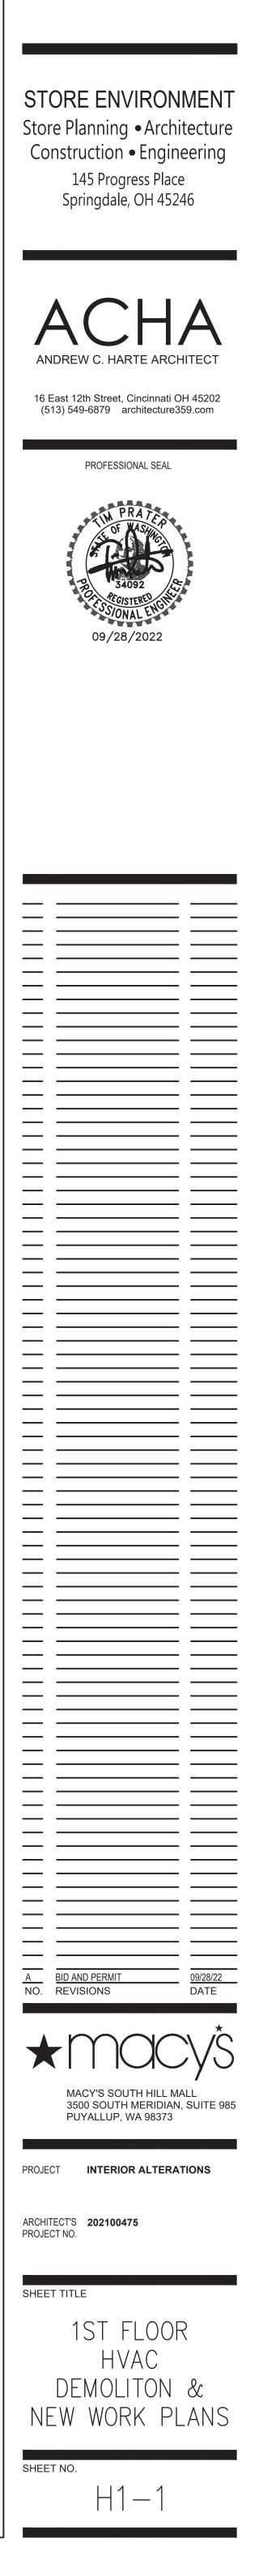


max in a

IOCVS II

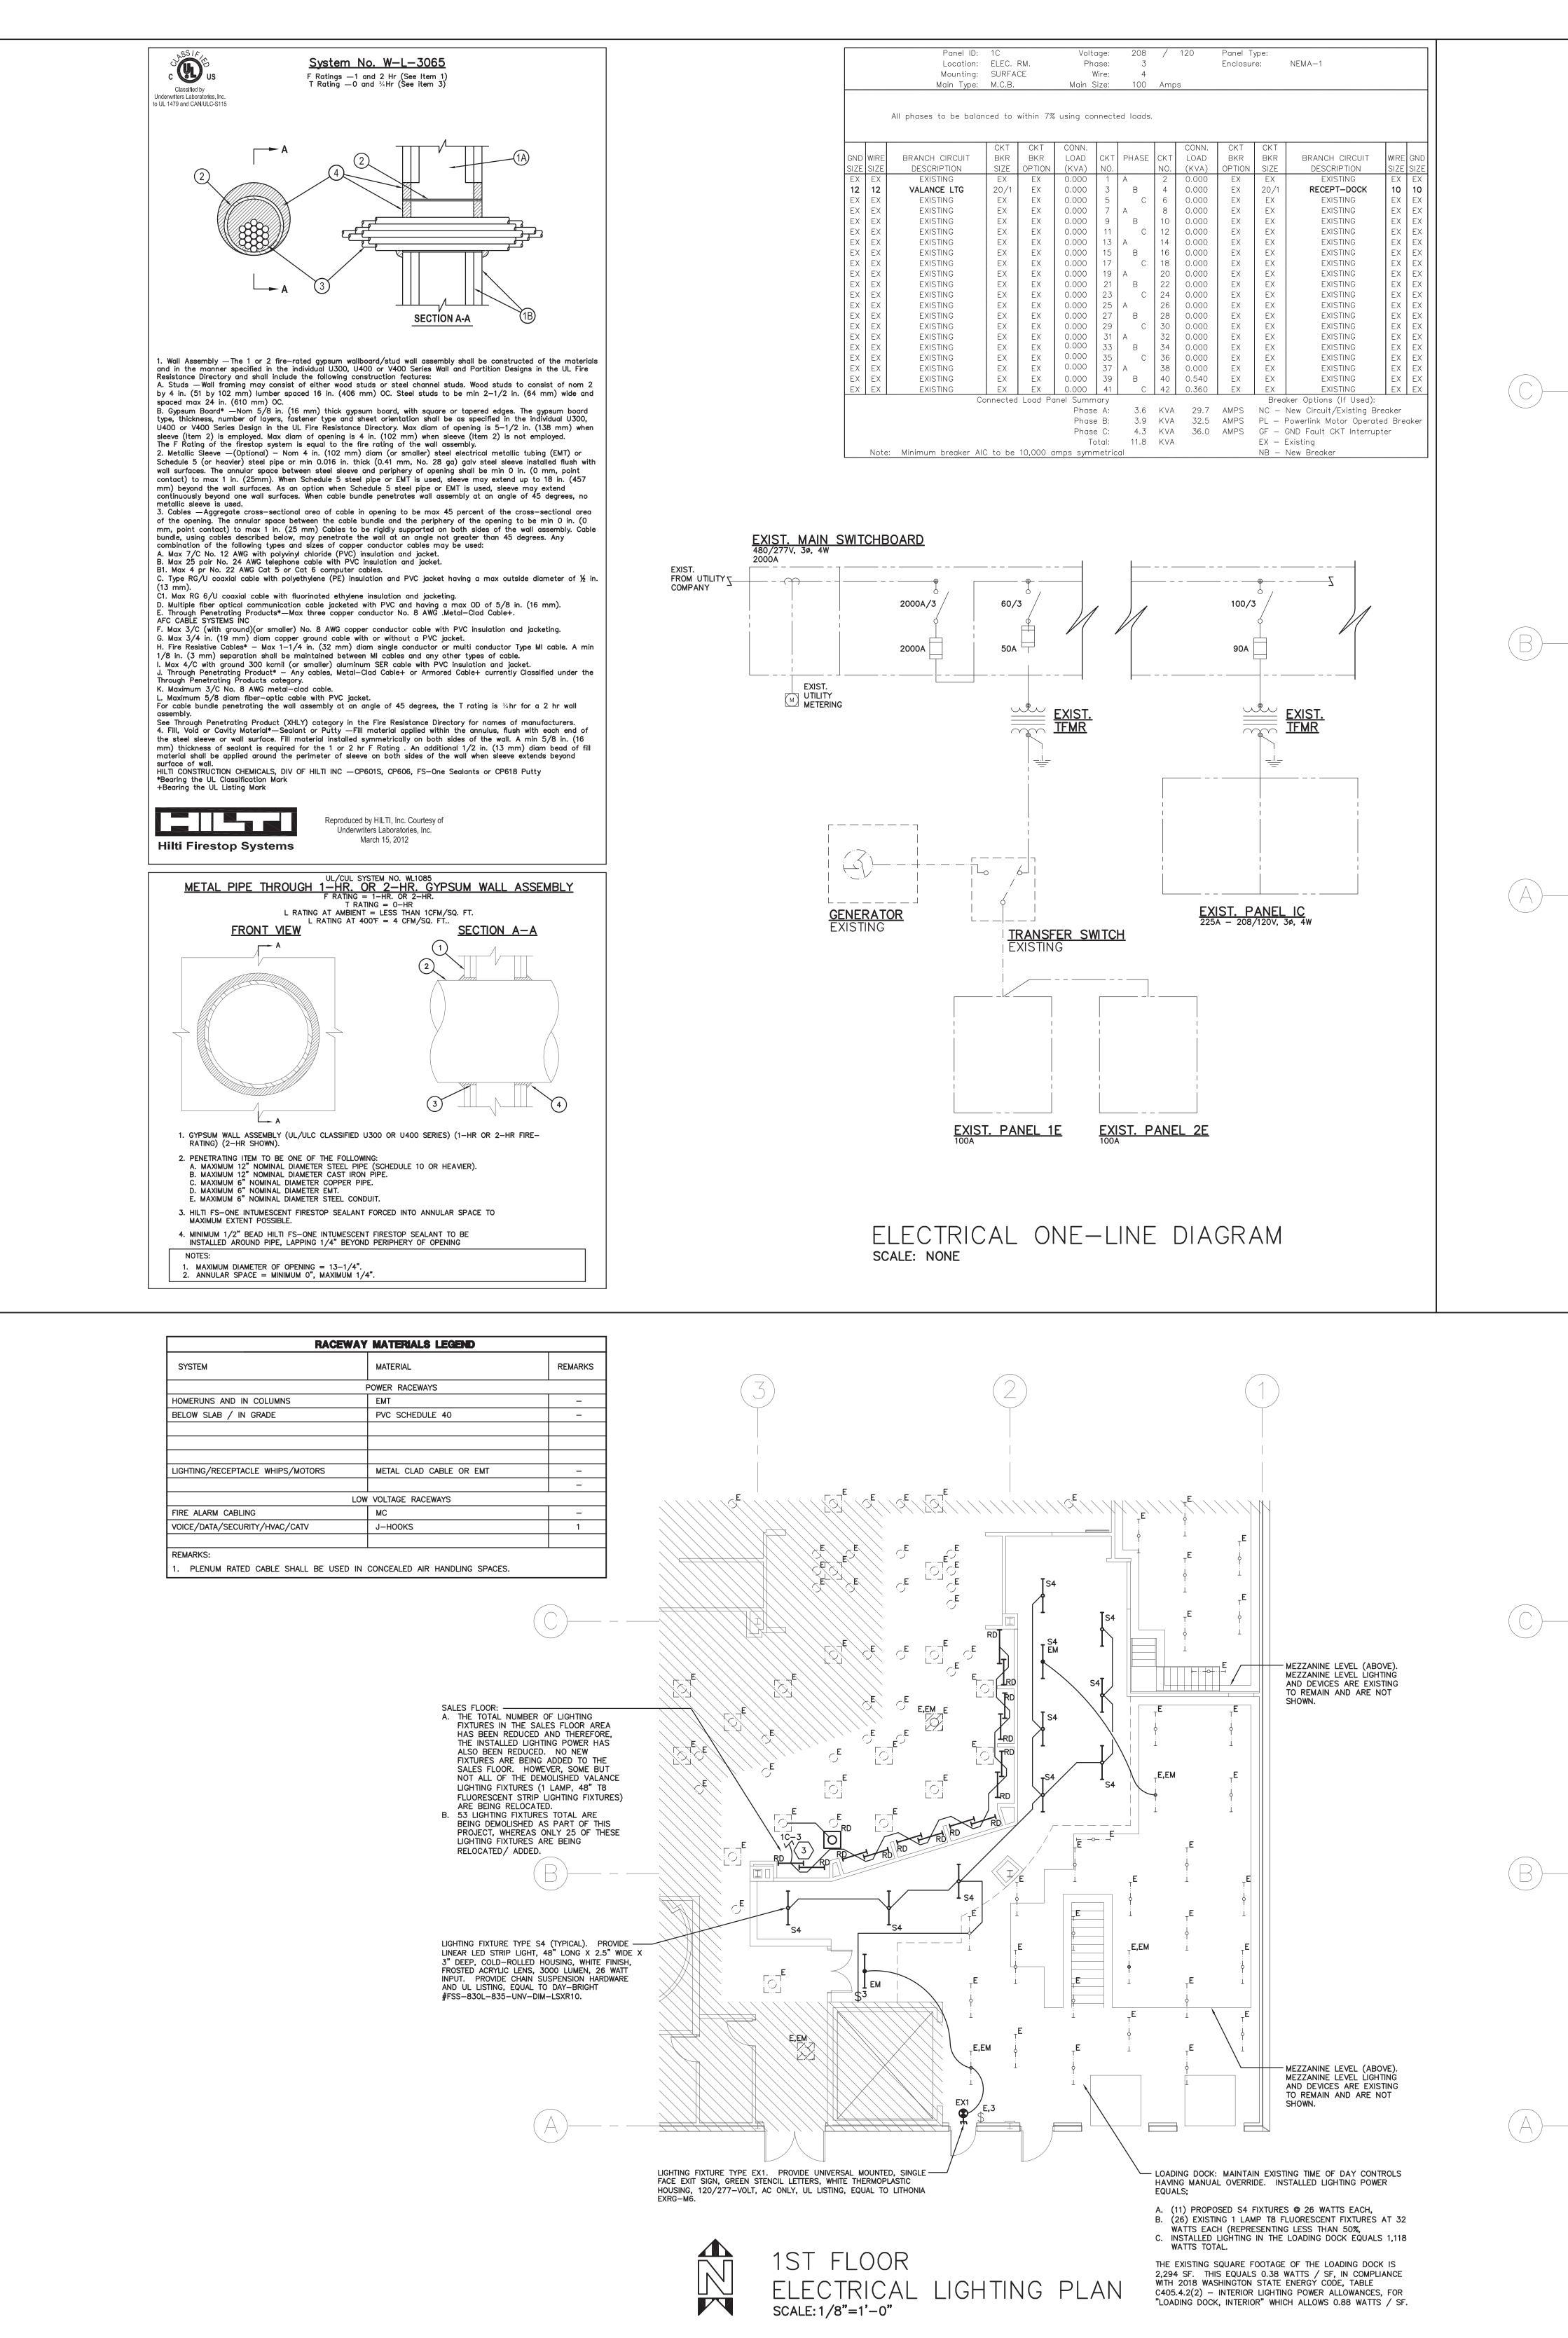


SYSTEM	MATERIAL	REMARKS
	POWER RACEWAYS	Į
HOMERUNS AND IN COLUMNS	EMT	_
BELOW SLAB / IN GRADE	PVC SCHEDULE 40	-
LIGHTING/RECEPTACLE WHIPS/MOTORS	METAL CLAD CABLE OR EMT	-
		_
	LOW VOLTAGE RACEWAYS	
FIRE ALARM CABLING	MC	-
VOICE/DATA/SECURITY/HVAC/CATV	J-HOOKS	1




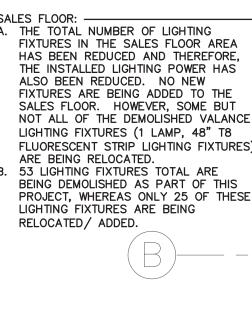




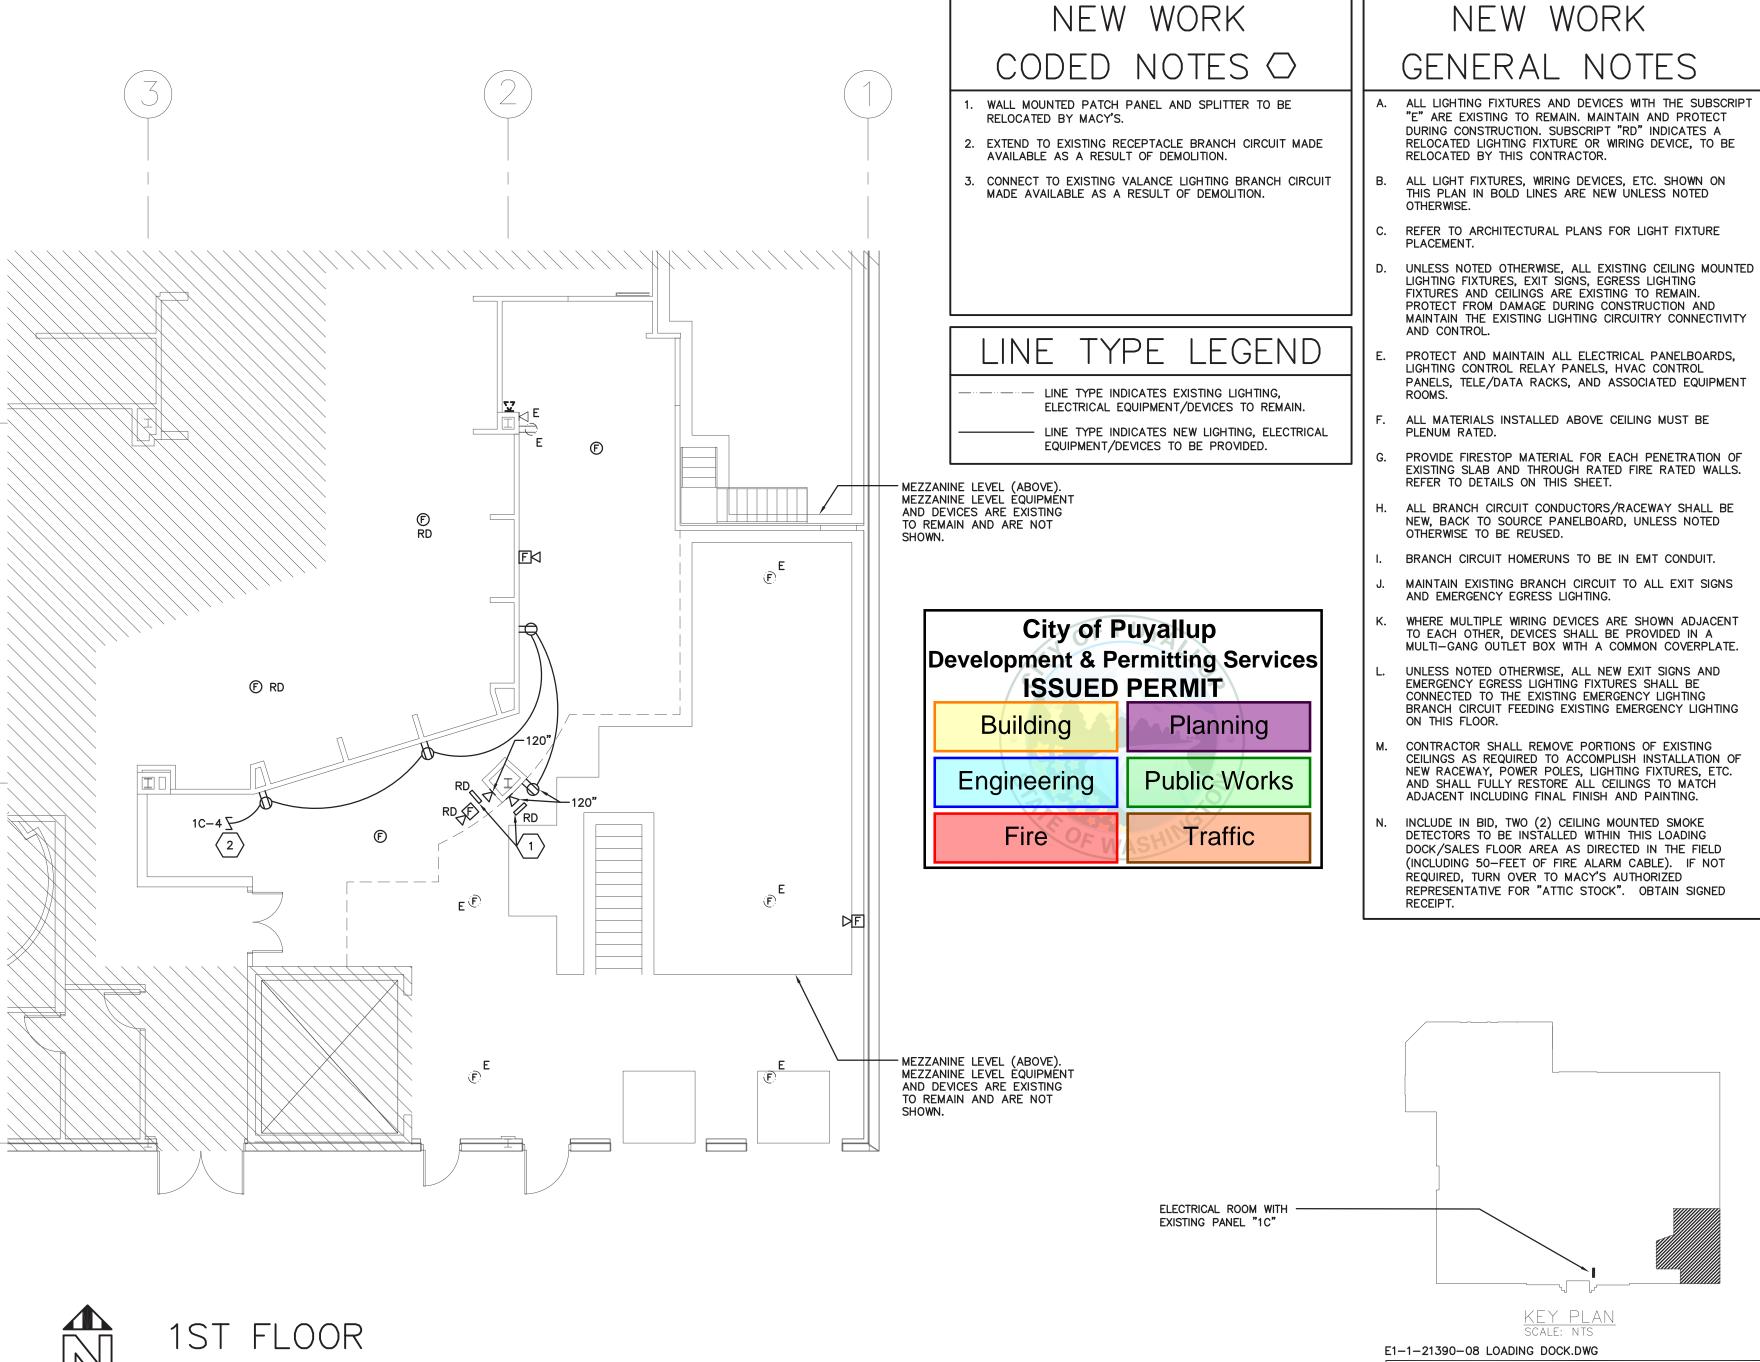



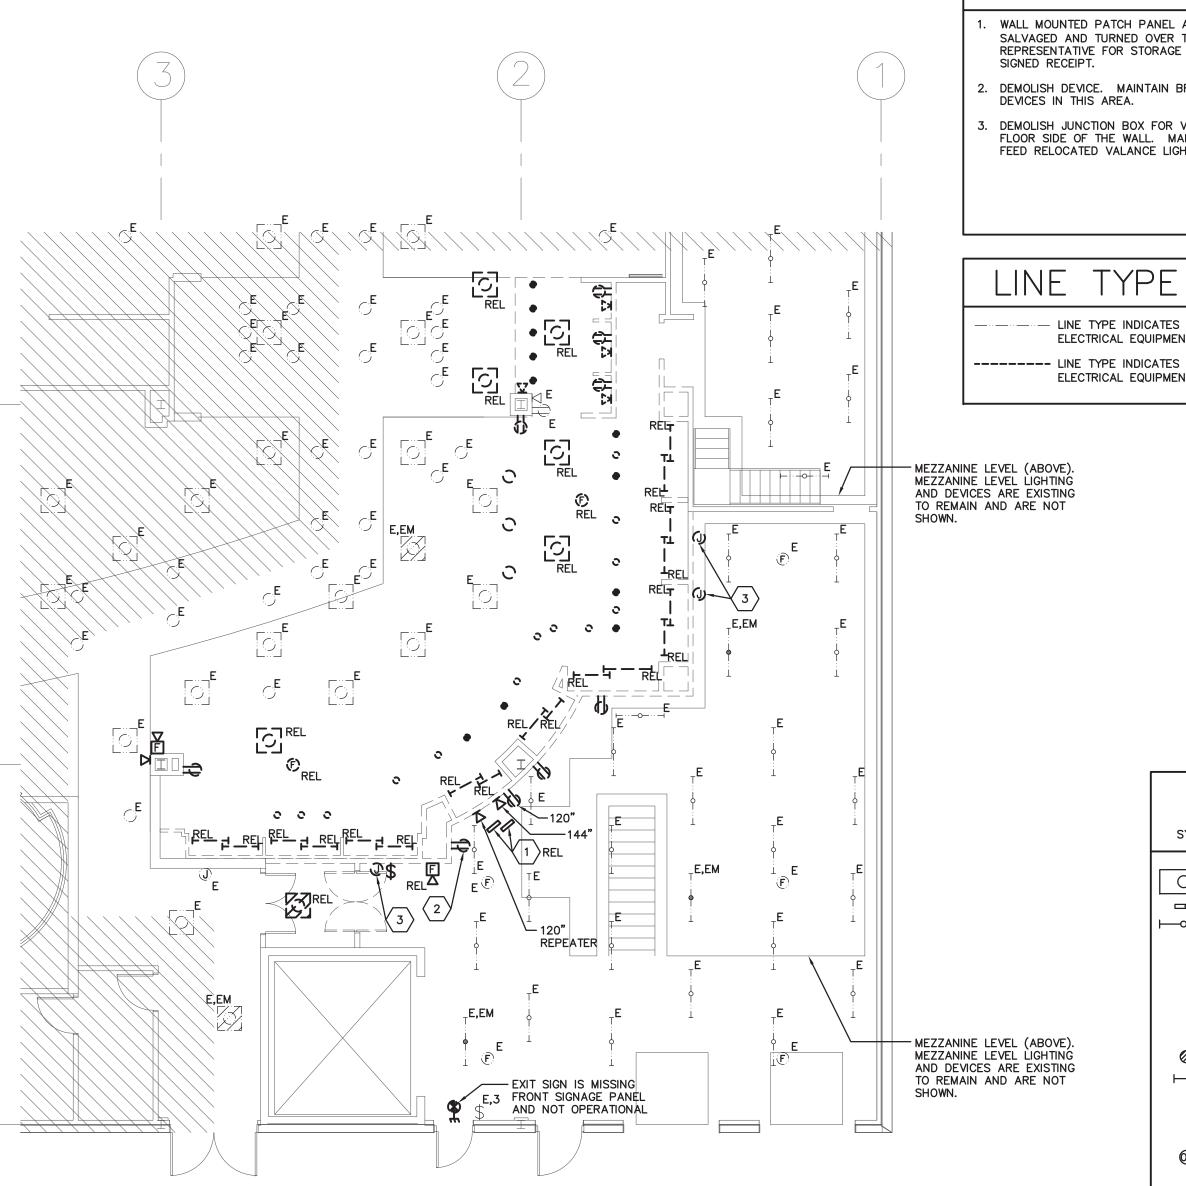

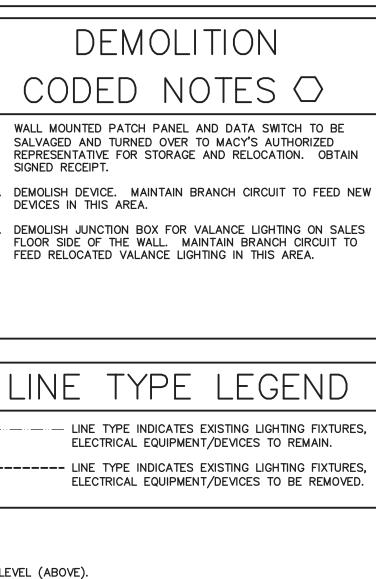




DEMOLITION PLAN, A101.2 FOR ADDITIONAL NOTATION. DEMOLISH WIRING DEVICES IN WALLS BEING DEMOLISHED. NOT ALL EXISTING DEVICES MAY BE SHOWN. UNLESS NOTED OTHERWISE, REMOVE ALL WIRE AND CONDUIT FROM DEMOLISHED WIRING DEVICES BACK TO SOURCE OR NEXT UPSTREAM EQUIPMENT TO REMAIN. MAKE JUNCTIONS AND EXTEND CIRCUITRY TO MAINTAIN POWER AND CONTROL TO LL DOWNSTREAM EQUIPMENT TO REMAIN. REMOVE ALL

- ASSOCIATED UNUSED PATHWAYS AND HARDWARE. UNLESS NOTED OTHERWISE, ALL EXISTING CEILING MOUNTED LIGHTING FIXTURES, EXIT SIGNS, EGRESS LIGHTING FIXTURES AND CEILINGS ARE EXISTING TO REMAIN. PROTECT FROM DAMAGE DURING CONSTRUCTION AND MAINTAIN THE EXISTING LIGHTING CIRCUITRY CONNECTIVITY AND CONTROL. IF LOCAL LIGHTING CONTROLS ARE DEMOLISHED THEN PROVIDE TEMPORARY MANUAL CONTROL OF EXISTING LIGHTING VIA CIRCUIT BREAKER IN SOURCE
- PANELBOARD. DEMOLISH UNDER-SHELF AND VALANCE LIGHTING FIXTURES AT WALLS BEING DEMOLISHED. REMOVE ALL WIRE AND CONDUIT FROM DEMOLISHED LIGHTING FIXTURES BACK TO SOURCE OR NEXT UPSTREAM LIGHTING FIXTURE TO REMAIN. MAKE JUNCTIONS AND EXTEND CIRCUITRY TO MAINTAIN POWER AND CONTROL TO ALL DOWNSTREAM LIGHTING FIXTURES TO REMAIN. REMOVE ALL ASSOCIATED UNUSED
- PATHWAYS AND HARDWARE. PROTECT AND MAINTAIN ALL ELECTRICAL PANELBOARDS, LIGHTING CONTROL RELAY PANELS, HVAC CONTROL PANELS, TELE/DATA RACKS, AND ASSOCIATED EQUIPMENT ROOM
- ALL DEVICES WITH THE SUBSCRIPT "E" ARE EXISTING TO REMAIN. MAINTAIN AND PROTECT DURING CONSTRUCTION. SUBSCRIPT "REL" INDICATES A WIRING DEVICE TO BE RELOCATED BY THIS CONTRACTOR. CONTRACTOR SHALL REMOVE PORTIONS OF EXISTING
- CEILINGS AS REQUIRED TO ACCOMPLISH DEMOLITION INDICATED ON THE DRAWINGS AND SHALL FULLY RESTORE ALL CEILINGS TO MATCH ADJACENT INCLUDING FINAL FINISH AND PAINTING.

ELECTRICAL LEGEND				
SYMBOL	DESCRIPTION		MOUNTING HGT. TO CENTER UNLESS OTHERWISE NOTED	
	CEILING OR WALL MOUNTED LIGHTIN "R2", "W2"; SEE LIGHTING FIXTURE			
€ € € € € €	EXIT SIGN FIXTURE (WITH DIRECTION SHOWN) (TYPE AND MOUNTING AS I LIGHTING FIXTURE SCHEDULE)	IAL ARROWS AS NOTED: SEE	90"	
€M €M EM EM	LIGHTING FIXTURE CONNECTED TO E	MERGENCY POWER	SEE DRAWINGS	
\$2; 3; 4; K; P	, SPECIAL SWITCH: 2-WAY; 3-WAY; OPERATED; SWITCH WITH PILOT LIGH	4-WAY; KEY HT	42"	
©\$\$os	OCCUPANCY SENSOR; CEILING / WA	ALL MOUNTED LINE V	/OLTAGE 42"	
₽	DUPLEX RECEPTACLE; 3 WIRE GROU	JND TYPE	18"	
	DOUBLE DUPLEX RECEPTACLE		18"	
J	JUNCTION BOX; WALL MOUNTED		SEE DRAWINGS	
	COMBINATION TELEPHONE / DATA OUTLET 18"			
Ē	SMOKE DETECTOR - CEILING MOUN	TED/WALL MOUNTED		
EA	FIRE ALARM SIGNAL - HORN/STROP	BE, WALL MOUNTED	80"	
	CCTV CAMERA - CEILING MOUNTED			
ELECTRICAL ABBREVIATIONS				
AWG	AMERICAN WIRE GAUGE	GRD	GROUND	
A	AMPERE	H.C.	MECHANICAL CONTROACTOR	
AFF	ABOVE FINISHED FLOOR	LTG	LIGHTING	
CLG	CEILING	MECH	MECHANICAL	
с	CONDUIT	MTD	MOUNTED	
E.C./EC/ELC	ELECTRICAL CONTRACTOR	P.C.	PLUMBING CONTRACTOR	

7		11.0.	MECHANICAL CONTROLOTOR
AFF	ABOVE FINISHED FLOOR	LTG	LIGHTING
CLG	CEILING	MECH	MECHANICAL
с	CONDUIT	MTD	MOUNTED
E.C./EC/ELC	ELECTRICAL CONTRACTOR	P.C.	PLUMBING CONTRACTOR
E	EXISTING TO REMAIN	PNL	PANEL
FACP	FIRE ALARM CONTROL PANEL	RECEPT	RECEPTACLE
FIX	FIXTURE	TYP	TYPICAL
G.C.	GENERAL CONTRACTOR	WP	WEATHERPROOF
WORK		NEW	WORK

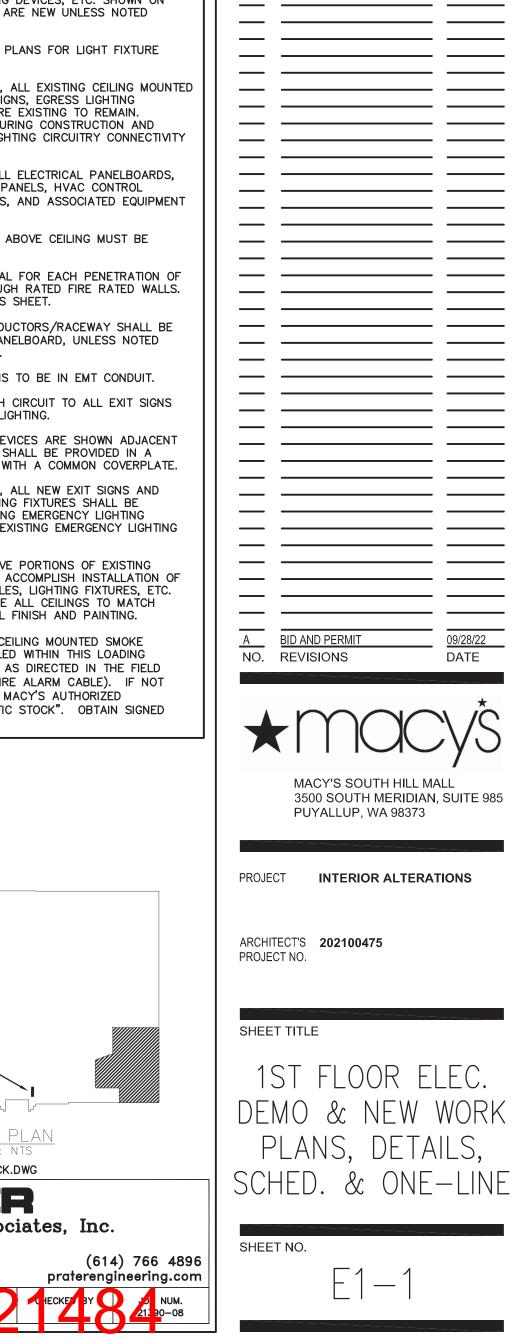




STORE ENVIRONMENT Store Planning • Architecture Construction • Engineering 145 Progress Place Springdale, OH 45246



16 East 12th Street, Cincinnati OH 45202 (513) 549-6879 architecture359.com

PROFESSIONAL SEAL



\_\_\_\_\_

\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_ \_\_\_\_

\_\_\_\_\_ \_ \_\_\_\_

\_\_\_\_\_

\_\_\_\_ \_\_\_\_

\_\_\_\_

\_\_\_\_\_ \_\_\_\_

\_\_\_\_

\_\_\_\_

GE	GRD	GROUND			
	H.C.	MECHANICAL CON			
OR	LTG	LIGHTING			
	MECH	MECHANICAL			
	MTD	MOUNTED			
CTOR	P.C.	PLUMBING CONTR			
	PNL	PANEL			
L PANEL	RECEPT	RECEPTACLE			
	TYP	TYPICAL			
DR	WP	WEATHERPROOF			
	NEW '	WORK			
GENERAL NOTE					
"E" ARE DURING RELOCA	ALL LIGHTING FIXTURES AND DEVICES WITH THE "E" ARE EXISTING TO REMAIN. MAINTAIN AND F DURING CONSTRUCTION. SUBSCRIPT "RD" INDIC. RELOCATED LIGHTING FIXTURE OR WIRING DEVIC RELOCATED BY THIS CONTRACTOR.				
B. ALL LIGI THIS PL OTHERW	AN IN BOLD LINE	ING DEVICES, ETC. SH S ARE NEW UNLESS N			
C. REFER 1		I PLANS FOR LIGHT F			

PRATER


6130 Wilcox Road


PRC DESIG ED BY DRAWN BI R. G. RDNEP GAPONER

Dublin, Ohio 43016


Engineering Associates, Inc.



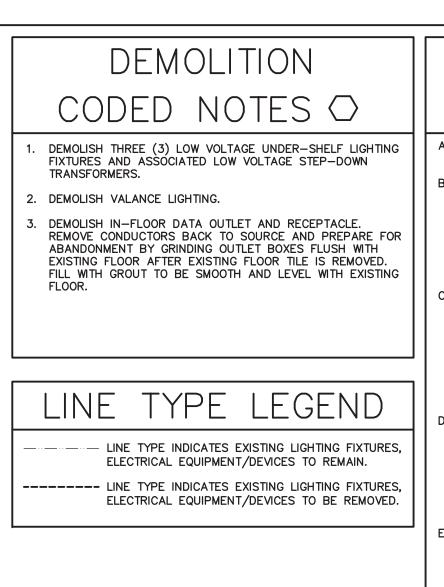

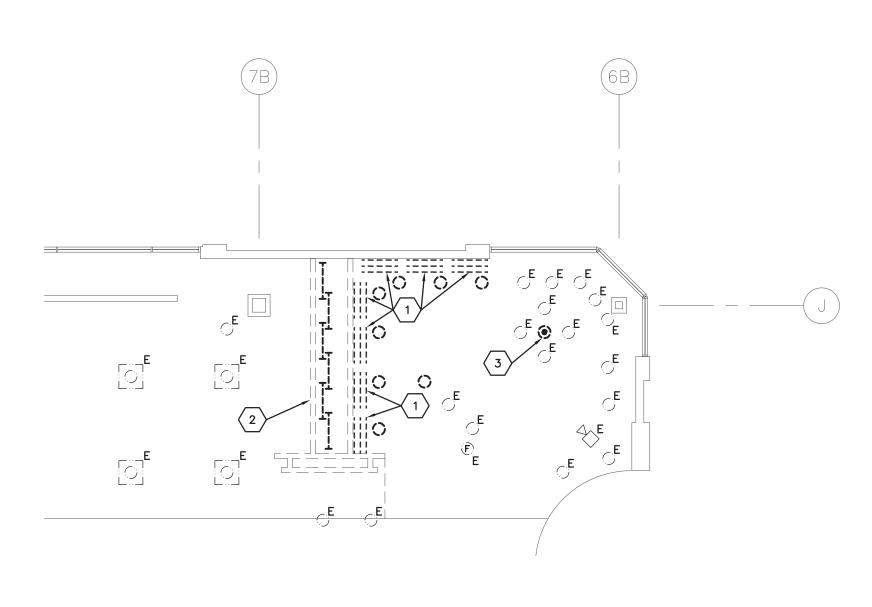



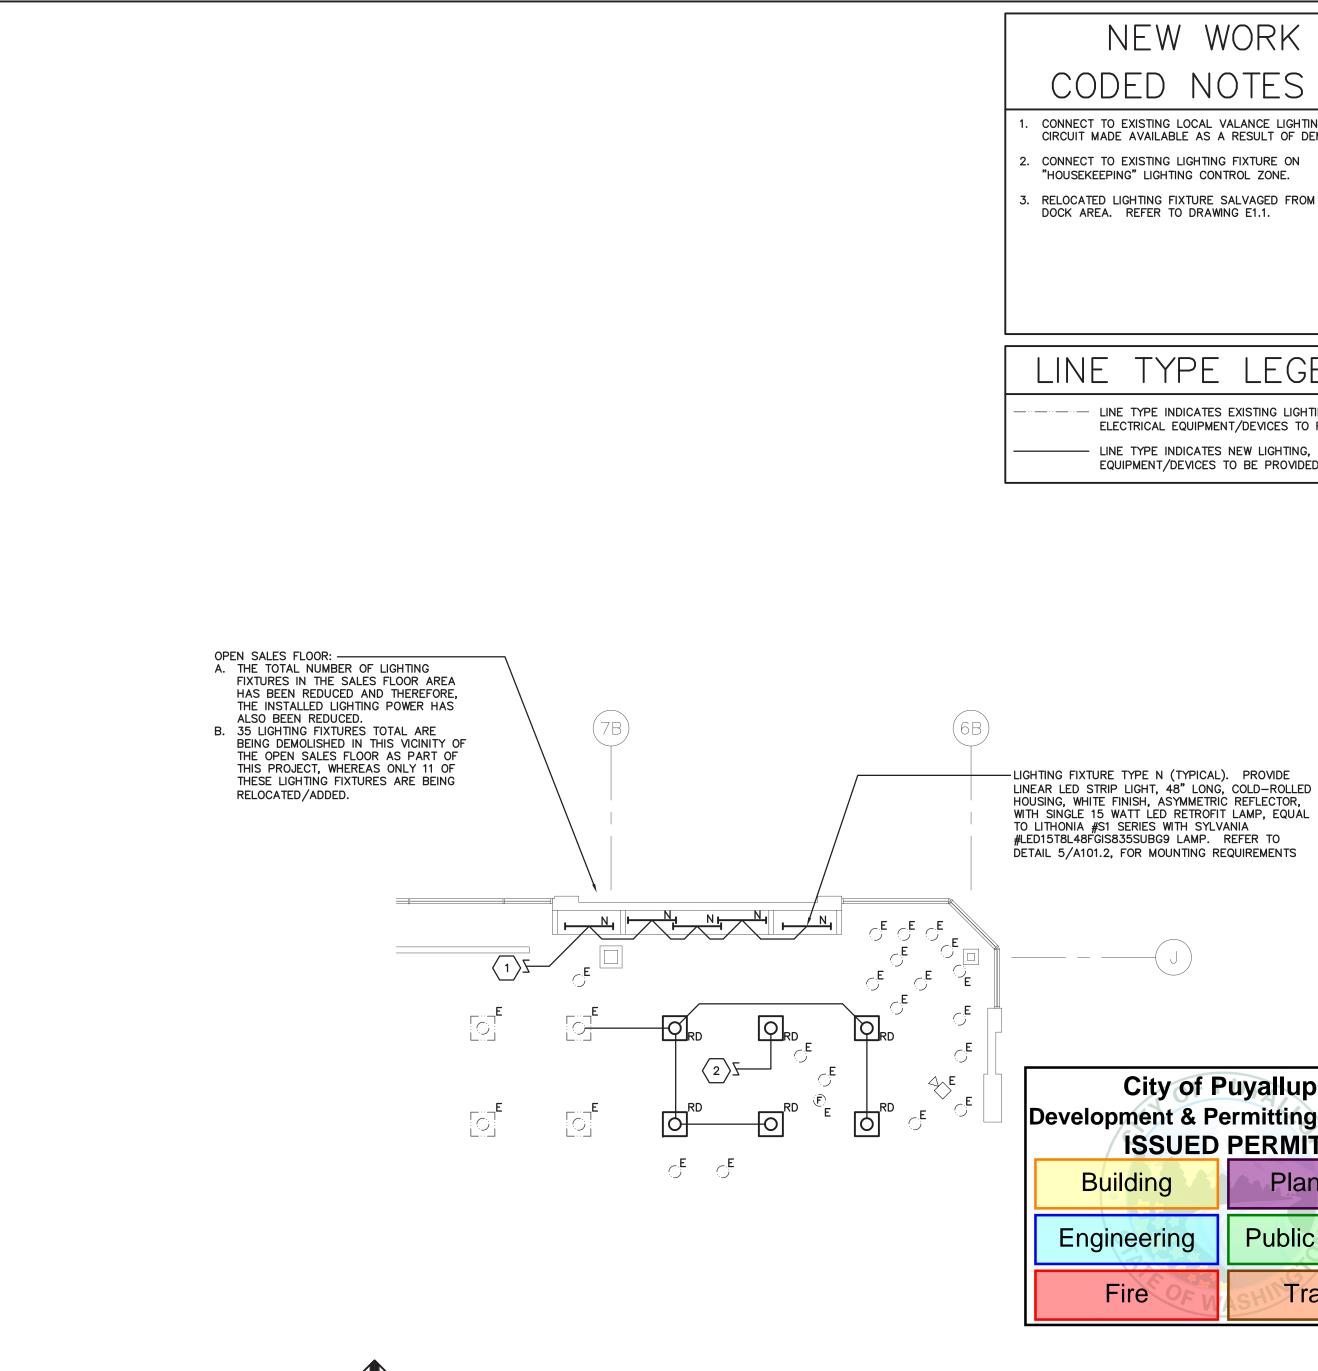



PARTIAL 1ST FLOOR SALES AREA ELECTRICAL PLAN scale:1/8"=1'-0"



- DEMOLISH WIRING DEVICES IN WALLS BEING DEMOLISHED. NOT ALL EXISTING DEVICES MAY BE SHOWN. UNLESS NOTED OTHERWISE, REMOVE ALL WIRE AND CONDUIT FROM DEMOLISHED WIRING DEVICES BACK TO SOURCE OR NEXT UPSTREAM EQUIPMENT TO REMAIN. MAKE JUNCTIONS AND EXTEND CIRCUITRY TO MAINTAIN POWER AND CONTROL TO ALL DOWNSTREAM EQUIPMENT TO REMAIN. REMOVE ALL ASSOCIATED UNUSED PATHWAYS AND HARDWARE.
- . UNLESS NOTED OTHERWISE, ALL EXISTING CEILING MOUNTED LIGHTING FIXTURES, EXIT SIGNS, EGRESS LIGHTING FIXTURES AND CEILINGS ARE EXISTING TO REMAIN. PROTECT FROM DAMAGE DURING CONSTRUCTION AND MAINTAIN THE EXISTING LIGHTING CIRCUITRY CONNECTIVITY AND CONTROL. IF LOCAL LIGHTING CINCOTROLS ARE DEMOLISHED THEN PROVIDE TEMPORARY MANUAL CONTROL OF EXISTING LIGHTING VIA CIRCUIT BREAKER IN SOURCE PANELBOARD.
- DEMOLISH UNDER-SHELF AND VALANCE LIGHTING FIXTURES AT WALLS BEING DEMOLISHED. REMOVE ALL WIRE AND CONDUIT FROM DEMOLISHED LIGHTING FIXTURES BACK TO SOURCE OR NEXT UPSTREAM LIGHTING FIXTURE TO REMAIN. MAKE JUNCTIONS AND EXTEND CIRCUITRY TO MAINTAIN POWER AND CONTROL TO ALL DOWNSTREAM LIGHTING FIXTURES TO REMAIN. REMOVE ALL ASSOCIATED UNUSED PATHWAYS AND HARDWARE.
- PROTECT AND MAINTAIN ALL ELECTRICAL PANELBOARDS, LIGHTING CONTROL RELAY PANELS, HVAC CONTROL PANELS, TELE/DATA RACKS, AND ASSOCIATED EQUIPMENT ROOMS
- ALL DEVICES WITH THE SUBSCRIPT "E" ARE EXISTING TO REMAIN. MAINTAIN AND PROTECT DURING CONSTRUCTION. SUBSCRIPT "REL" INDICATES A WIRING DEVICE TO BE RELOCATED BY THIS CONTRACTOR. CONTRACTOR SHALL REMOVE PORTIONS OF EXISTING
- CEILINGS AS REQUIRED TO ACCOMPLISH DEMOLITION INDICATED ON THE DRAWINGS AND SHALL FULLY RESTORE ALL CEILINGS TO MATCH ADJACENT INCLUDING FINAL FINISH AND PAINTING.



WORK	NEW WORK	
NOTES O	GENERAL NOTES	
LOCAL VALANCE LIGHTING BRANCH LE AS A RESULT OF DEMOLITION. LIGHTING FIXTURE ON NG CONTROL ZONE.	A. ALL LIGHTING FIXTURES AND DEVICES WITH THE SUBSCRIPT "E" ARE EXISTING TO REMAIN. MAINTAIN AND PROTECT DURING CONSTRUCTION. SUBSCRIPT "RD" INDICATES A RELOCATED LIGHTING FIXTURE OR WIRING DEVICE, TO BE RELOCATED BY THIS CONTRACTOR.	
XTURE SALVAGED FROM LOADING DRAWING E1.1.	B. ALL LIGHT FIXTURES, WIRING DEVICES, ETC. SHOWN ON THIS PLAN IN BOLD LINES ARE NEW UNLESS NOTED OTHERWISE.	
	C. REFER TO ARCHITECTURAL PLANS FOR LIGHT FIXTURE PLACEMENT.	
	D. UNLESS NOTED OTHERWISE, ALL EXISTING CEILING MOUNTED LIGHTING FIXTURES, EXIT SIGNS, EGRESS LIGHTING FIXTURES AND CEILINGS ARE EXISTING TO REMAIN. PROTECT FROM DAMAGE DURING CONSTRUCTION AND MAINTAIN THE EXISTING LIGHTING CIRCUITRY CONNECTIVITY AND CONTROL.	
PE LEGEND	E. PROTECT AND MAINTAIN ALL ELECTRICAL PANELBOARDS, LIGHTING CONTROL RELAY PANELS, HVAC CONTROL PANELS, TELE/DATA RACKS, AND ASSOCIATED EQUIPMENT	
DICATES EXISTING LIGHTING, QUIPMENT/DEVICES TO REMAIN. DICATES NEW LIGHTING, ELECTRICAL	ROOMS. F. ALL MATERIALS INSTALLED ABOVE CEILING MUST BE PLENUM RATED.	
EVICES TO BE PROVIDED.	G. PROVIDE FIRESTOP MATERIAL FOR EACH PENETRATION OF EXISTING SLAB AND THROUGH RATED FIRE RATED WALLS. REFER TO DETAILS ON DRAWING E1-1.	
	H. ALL BRANCH CIRCUIT CONDUCTORS/RACEWAY SHALL BE NEW, BACK TO SOURCE PANELBOARD, UNLESS NOTED OTHERWISE TO BE REUSED.	
	I. BRANCH CIRCUIT HOMERUNS TO BE IN EMT CONDUIT. J. MAINTAIN EXISTING BRANCH CIRCUIT TO ALL EXIT SIGNS	
	AND EMERGENCY EGRESS LIGHTING. K. UNLESS NOTED OTHERWISE, ALL NEW EXIT SIGNS AND	
	EMERGENCY EGRESS LIGHTING FIXTURES SHALL BE CONNECTED TO THE EXISTING EMERGENCY LIGHTING BRANCH CIRCUIT FEEDING EXISTING EMERGENCY LIGHTING ON THIS FLOOR.	
TYPICAL). PROVIDE	L. CONTRACTOR SHALL REMOVE PORTIONS OF EXISTING CEILINGS AS REQUIRED TO ACCOMPLISH INSTALLATION OF NEW RACEWAY, LIGHTING FIXTURES, ETC. AND SHALL FULLY RESTORE ALL CEILINGS TO MATCH ADJACENT INCLUDING FINAL FINISH AND PAINTING.	
" LONG, COLD-ROLLED MMETRIC REFLECTOR, ETROFIT LAMP, EQUAL	M. INCLUDE IN BID, ONE (1) CEILING MOUNTED SMOKE DETECTOR TO BE INSTALLED IN THIS OPEN SALES FLOOR AREA AS DIRECTED IN THE FIELD (INCLUDING 50-FEET OF	
H SYLVANIA LAMP. REFER TO TING REQUIREMENTS	FIRE ALARM CABLE). IF NOT REQUIRED, TURN OVER TO MACY'S AUTHORIZED REPRESENTATIVE FOR "ATTIC STOCK". OBTAIN SIGNED RECEIPT.	ABID AND PERMIT09/28/22NO.REVISIONSDATE
		★ MOCYS
~		MACY'S SOUTH HILL MALL 3500 SOUTH MERIDIAN, SUITE 985 PUYALLUP, WA 98373
of Puyallup & Permitting Service		PROJECT INTERIOR ALTERATIONS
		ARCHITECT'S <b>202100475</b> PROJECT NO.
Planning		
g Public Works		SHEET TITLE
Traffic		1ST FLOOR SALES AREA ELEC.
	KEY PLAN scale: nts	DEMO & NEW
	E1-1A-21390-08 LOADING DOCK.DWG	WORK PLANS
	<b>PRATER</b> Engineering Associates, Inc.	
	6130 Wilcox Road (614) 766 4896 Dublin, Ohio 43016 praterengineering.com	SHEET NO. E1-1A
PR(	DESIG ED BY DRAWN BY RECKET BY JOI NUM. R. G. RDNEP GAPONER LECKET BY JOI NUM. 21:90-08	