2015 International Residential Code (IRC) 2015 International Energy Conservation Code (IECC)

W/ Washington State Amendments

All Climate Zones	R-Value (A)	U-Factor (A)
enestration U-Factor (B)	N/A	0.30
Skylight U-Factor	N/A	0.50
Glazed Fenestration SHGC (B,E)	N/A	N/A
Ceilng	49 (J)	0.026
Wood Frame Wall (G,K,L)	21 INT	0.056
Mass Wall R-Value (I)	21/21 (H)	0.056
Floor	30 (G)	0.029
Below Grade Wall (C,K)	10/15/21 INT+TB	0.042
Slab (D) R-Value & Depth	10, 2ft	N/A

A) R-values are minimums. U-factors and SHGC are maximums. When insulation is installed in a cavity which is less than the label or design thickness of the insulation, the compressed R-value of the insulation from Appendix Table A101.4 shall not be less than the R-value specified in the table.

B) The fenestration U-factor column excludes skylights. The SHGC column applies to all glazed fenestration. Exception: Skylights may be excluded from glazed fenestration SHGC requirements in Climate Zones 1 through 3 where the SHGC for such skylights does not exceed 0.30.

C) "10/15/21.+TB" means R-10 continuous insulation on the exterior of the wall, or R-15 on the continuous insulation on the interior of the wall, or R-21 cavity insulation plus a thermal break between the slab and the basement wall at the interior of the basement wall. "10/15/21.+TB" shall be permitted to be met with R-13 cavity insulation on the interior of the basement wall plus R-5 continuous insulation on the interior or exterior of the wall. "10/13" means R-10 continuous insulation on the interior or exterior of the home or R-13 cavity insulation at the interior of the basement wall. "TB" means thermal break between floor slab and basement wall.

D) R-10 continuous insulation is required under heated slab on grade floors. See R402.2.9.1.

E) There are no SHGC requirements in the Marine Zone.

F) Reserved.

G) Reserved.

H) Reserved.

I) The second R-value applies when more than half the insulation is on the interior of the mass wall.

J) Reserved.

K) For Single Rafter or Joist Vaulted Ceilings, the Insulation may be reduced to R-38.

L) Reserved.

M) Int. (intermediate framing) denotes standard framing 16 inches on center with headers insulated with a minimum of

Table R402.1.3 Footnote A) Nonfenestration U-factors shall be obtained from measurement, calculation or an approved source or as specified in Section R402.1.3.

## Below are the Chosen Options for the 2015 Energy Code

Option	Description	Credit(s)
1A	Efficient Building Envelope 1A: Prescriptive Compliance is based on Table R402.1.1 with the following modifications: Fenestration U: 0.28 Floor: R-38 Slab on Grade: R-10 Perimeter and Under Entire Slab Below Grade Slab: R-10 Perimeter and Under Entire Slab or Compliance Based on Section R402.1.4: Reduce Total UA by 5%	0.5
3B	HIGH EFFICIENCY HVAC EQUIPMENT 3B: Air-source heat pump with minimum HSPF of 9.0 To qualify to claim this credit, the building permit drawings shall specify the option being selected and shall specify the heating equipment type and the minimum equipment efficiency	1.0
5A	EFFICIENT WATER HEATING 5A: All showerhead and kitchen sink faucets installed in the house shall be rated at 1.75 GPM or less. All other lavatory faucets shall be rated at 1.0 GPM or less. To qualify to claim this credit, the building permit drawings shall specify the option being selected and shall specify the maximum flow rates for all showerheads, kitchen sink faucets, and other lavatory faucets	0.5
5C	EFFICIENT WATER HEATING 5C: Water heating system shall include one of the following: Gas, propane or oil water heater with a minimum EF of 0.91 or Solar water heating supplementing a minimum standard water heater. Solar water heating will provide a rated minimum savings of 85 therms or 2000 kWh based on the Solar Rating and Certification Corporation (SRCC) Annual Performance of OG-300 Certified Solar Water Heating Systems or Electric heat pump water heater with a minimum EF of 2.0 and meeting the standards of NEEA's Northern Climate Specifications for Heat Pump Water Heaters To qualify to claim this credit, the building permit drawings shall specify the option being selected and shall specify the water heater equipment type and the minimum equipment efficiency and, for solar water heating systems, the calculation of the minimum energy savings	1.5

**Drafting Manager:** Customer:

Gabe Spruell Pacific Home Source 4001 72nd St. E. Tacoma, WA 98443 253.312.5523


Farris, Rich & Kathy 2345 West Stewart Puyallup, WA 98371 253-255-3413 Parcel # - 0420207029

Approval of submitted plans is not an approval of omissions or oversight by this office or noncompliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable building codes and regulations of the local government.

## **Design Criteria & Loads**

SINEERING MUST BE POSTED ON THE JOB AT ALL SPECTIONS IN A VISIBLE AND READILY CCESSIBLE LOCATION.

Roof Snow Load: 25 psf Floor Live Load: 40 psf Wind Speed (ASD): 85 mph Wind Speed (ULT): 100 mph Exposure: Seismic Zone: Frost Depth:



City of Puyallup

Building

**REVIEWED** 

**FOR** 

COMPLIANCE

\*\*Address MUST be located on the house where it is easily seen from the main access road (Homeowner Responsibility).\*\*

City of Puyallup Development & Permitting Service ISSUED PERMIT		
Building	Planning	
Engineering	Public Works	
Fire OF W	SHITTraffic	

## See Structural Engineering plans

See Geotechnical Report Migizi group April 21, 2016 for soil preparations. Excerpt below from pg 9 of 14. Observation by the geotechnical engineer is required per recommendations on 12 of 14 of the geotechnical report.

### 4.2 Spread Footings

In our opinion, conventional spread footings will provide adequate support for the residences if the subgrades are properly prepared. Due to the soft soils underlying the site, over-excavation of spread footing subgrades, to a depth of 3 feet, and the construction of structural fill bearing pads will be necessary for foundation support of the new structure.

Footing Depths and Widths: For frost and erosion protection, the bases of all exterior footings should bear at least 18 inches below adjacent outside grades, whereas the bases of interior footings need bear only 12 inches below the surrounding slab surface level. To reduce post-construction settlements, continuous (wall) and isolated (column) footings should be at least 16 and 24 inches wide, respectively.

Bearing Subgrades: Structural fill bearing pads, 3 feet thick and compacted to a density of at least 95 percent (based on ASTM:D-1557), should underlie spread footings on this site. Given the fact that the over-excavation will likely extend below the water table, we recommend that the bottom 12 inches of the bearing pads consist of 2-4 inch quarry spalls driven into the subgrade using a hoe pack.

In general, before footing concrete is placed, any localized zones of loose soils exposed across the footing subgrades should be compacted to a firm, unyielding condition, and any localized zones of soft, organic, or debris-laden soils should be overexcavated and replaced with suitable structural

Lateral Overexcavations: Because foundation stresses are transferred outward as well as downward into the bearing soils, all structural fill placed under footings, should extend horizontally outward from the edge of each footing. This horizontal distance should be equal to the depth of placed fill. Therefore, placed fill that extends 3 feet below the footing base should also extend 3 feet outward from the footing edges.

## **Area Summary**

1,500 Sq. Ft. Main Floor: 2,500 Sq. Ft. Upper Floor: **Conditioned Area:** 4,000 Sq. Ft. Garage Area: 780 Sq. Ft. 420 Sq. Ft **Covered Driveway:** 

500 Sq. Ft. Covered Front Porch: **Covered Patio:** 500 Sq. Ft.

6,200 Sq. Ft. Total Area:



## Post Address number at/near driveway.

R319.1 Address identification. (excerpt of code)

Buildings shall be provided with approved address identification. The address identification shall be legible and placed in a position that is visible from the street or road fronting the property. Address identification characters shall contrast with their background. Address numbers shall be Arabic numbers or alphabetical letters. Numbers shall not be spelled out. Each character shall be not less than 4 inches (102 mm) in height with a stroke width of not less than 0.5 inch (12.7 mm). Where access is by means of a private road and the building address cannot be viewed from the public way, a monument, pole or other sign or means shall be used to identify the structure. Address identification shall be maintained.

> 3D Isometric Drawings are for illustration ONLY! Plans, Details and Engineering take presidence over ANY 3D drawing within this plan.

	Sheet Index		
Pg#	Title		
1	Cover Sheet		
2	Elevations		
3	Elevations		
4	Main Floor		
5	Upper Floor		
6	Foundation & Framing		
7	Upper Floor Framing		
8	Roof Framing		
9	Cross Sections		
10	Details		
11	Details Continued		
12	General Notes		


4001 72nd St. E Tacoma, WA 984

Farris, Rich & Kathy

Cover Sheet

PHS Job #: 19.056 Printed On: 7/26/2023 18:36:47

Layout Sheet # 1 of 12

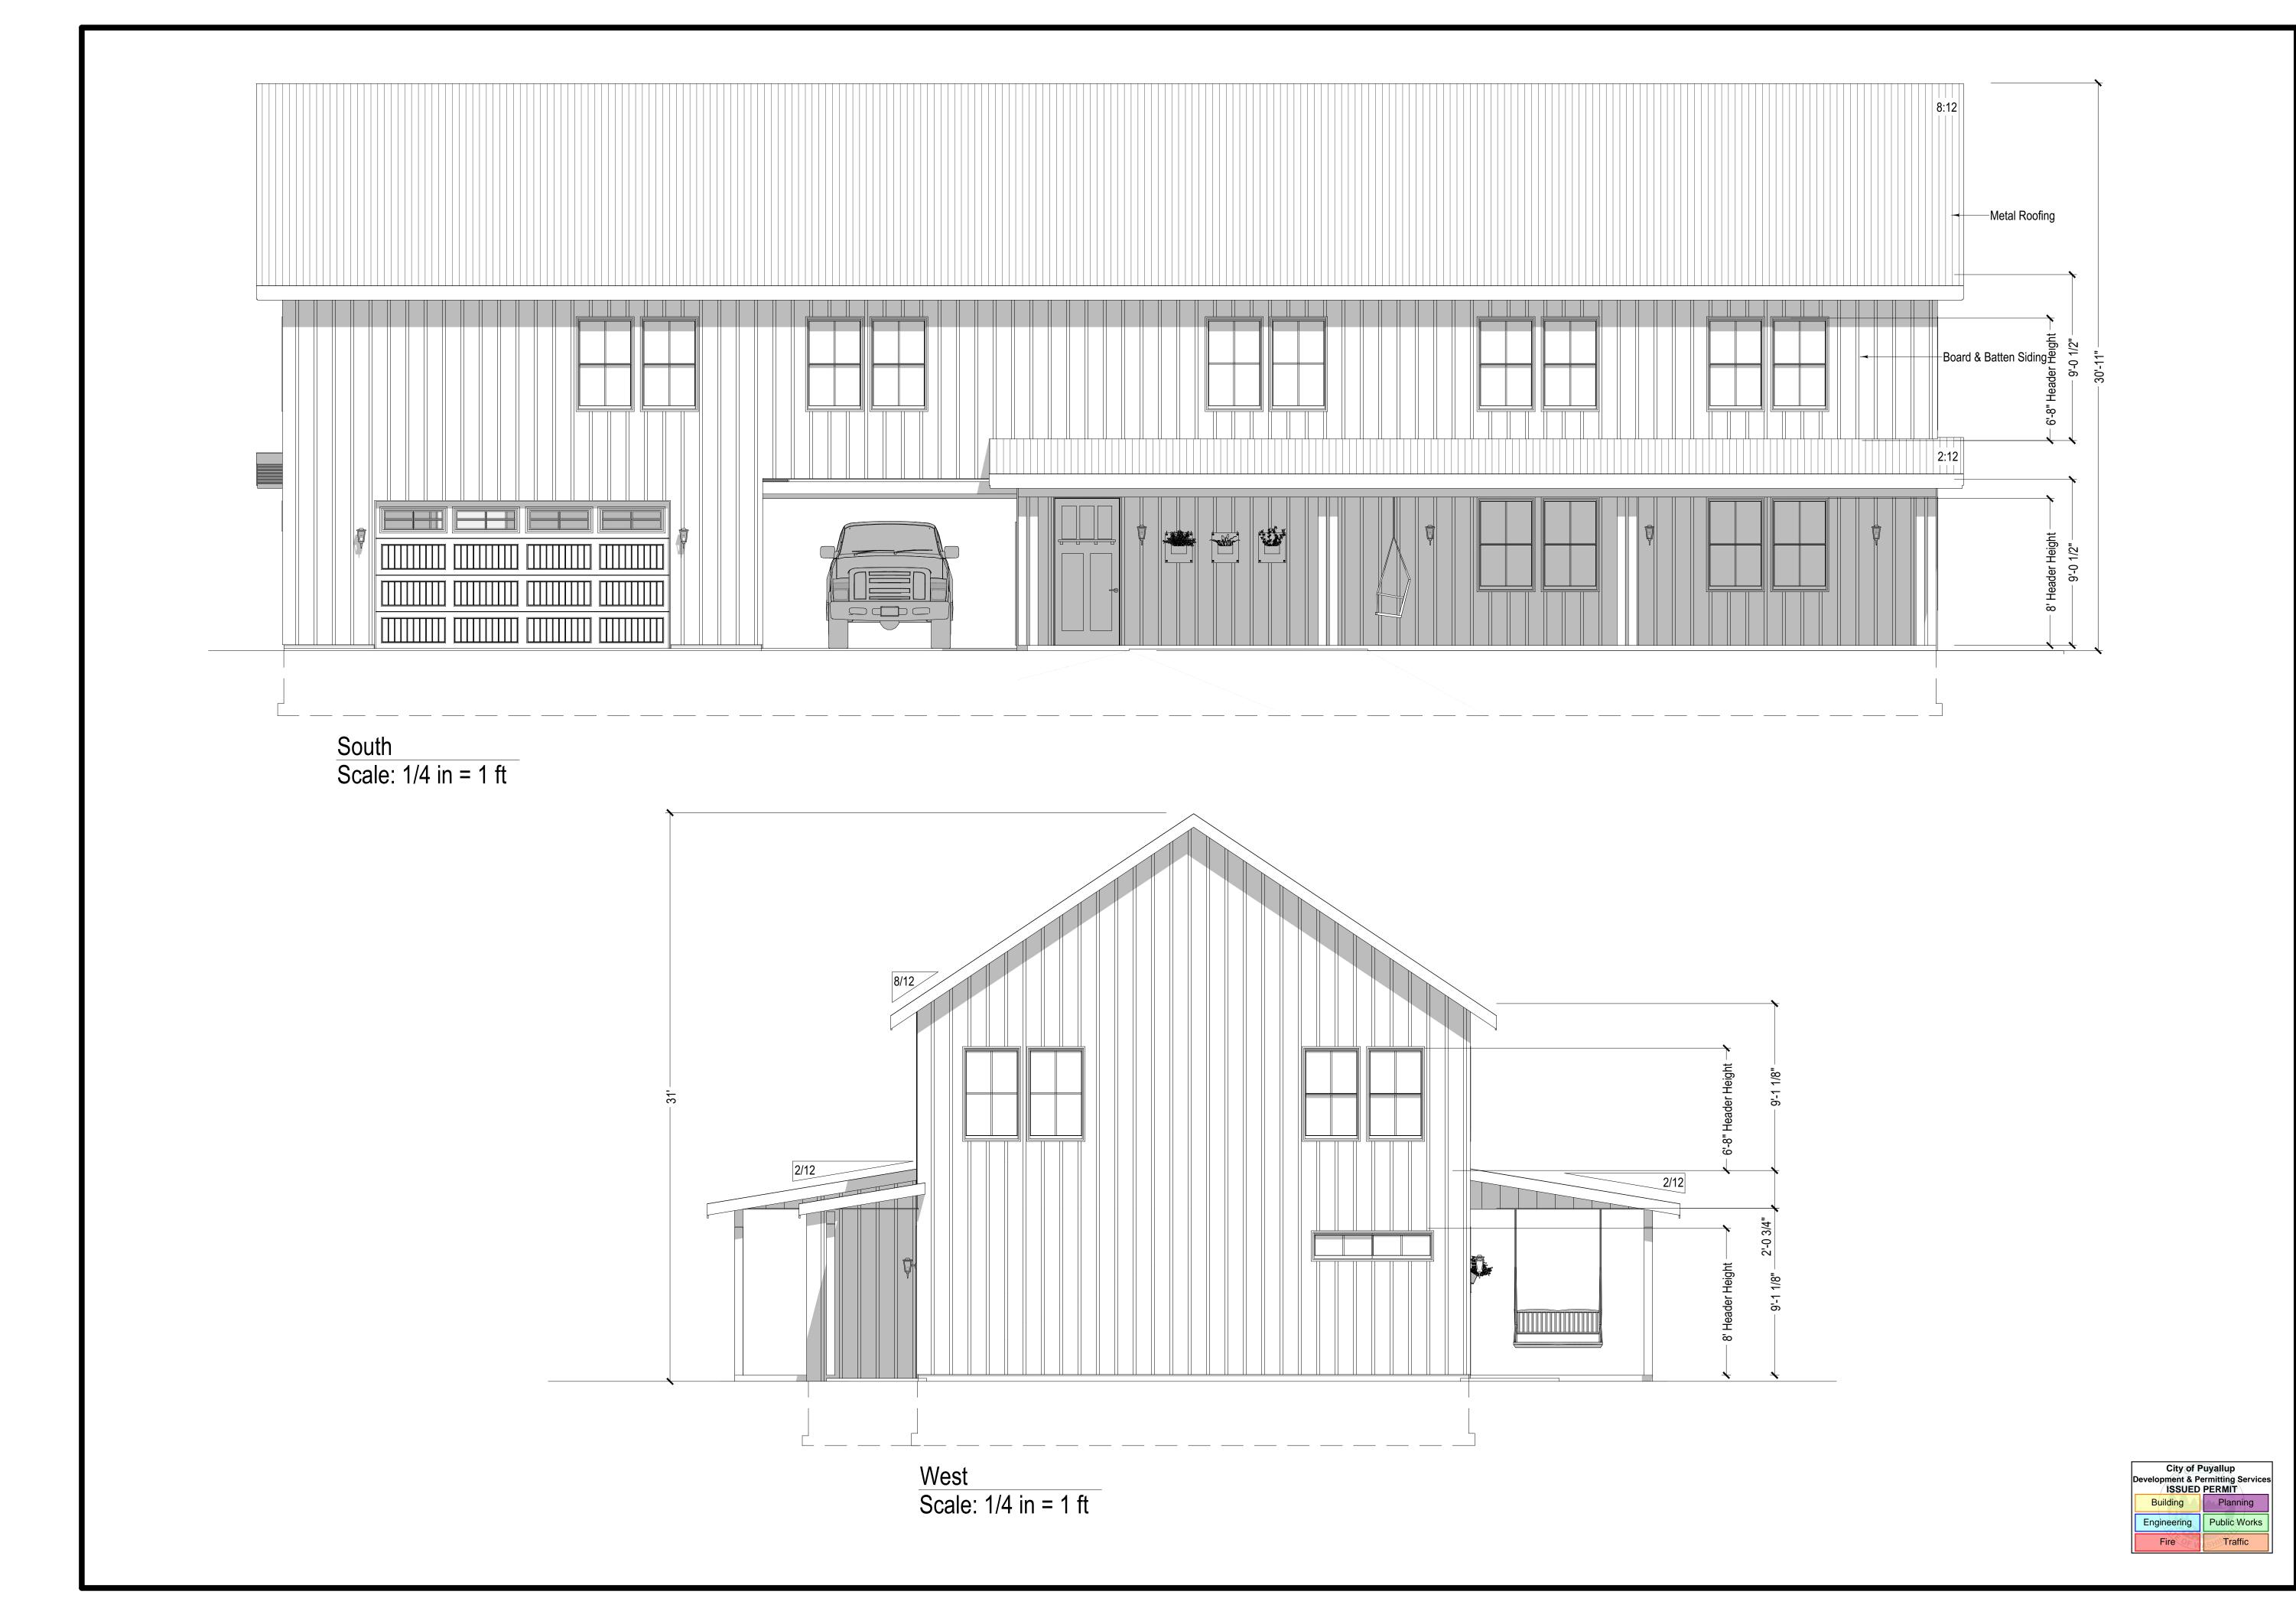


Farris, Rich & Kathy
2345 West Stewart
Puyallup, WA 98371
253-255-3413
Parcel # - 0420207029

Elevations

PHS Job #: 19.056

Printed On: 7/26/2023 18:36:47

Layout Sheet # 2 of 12

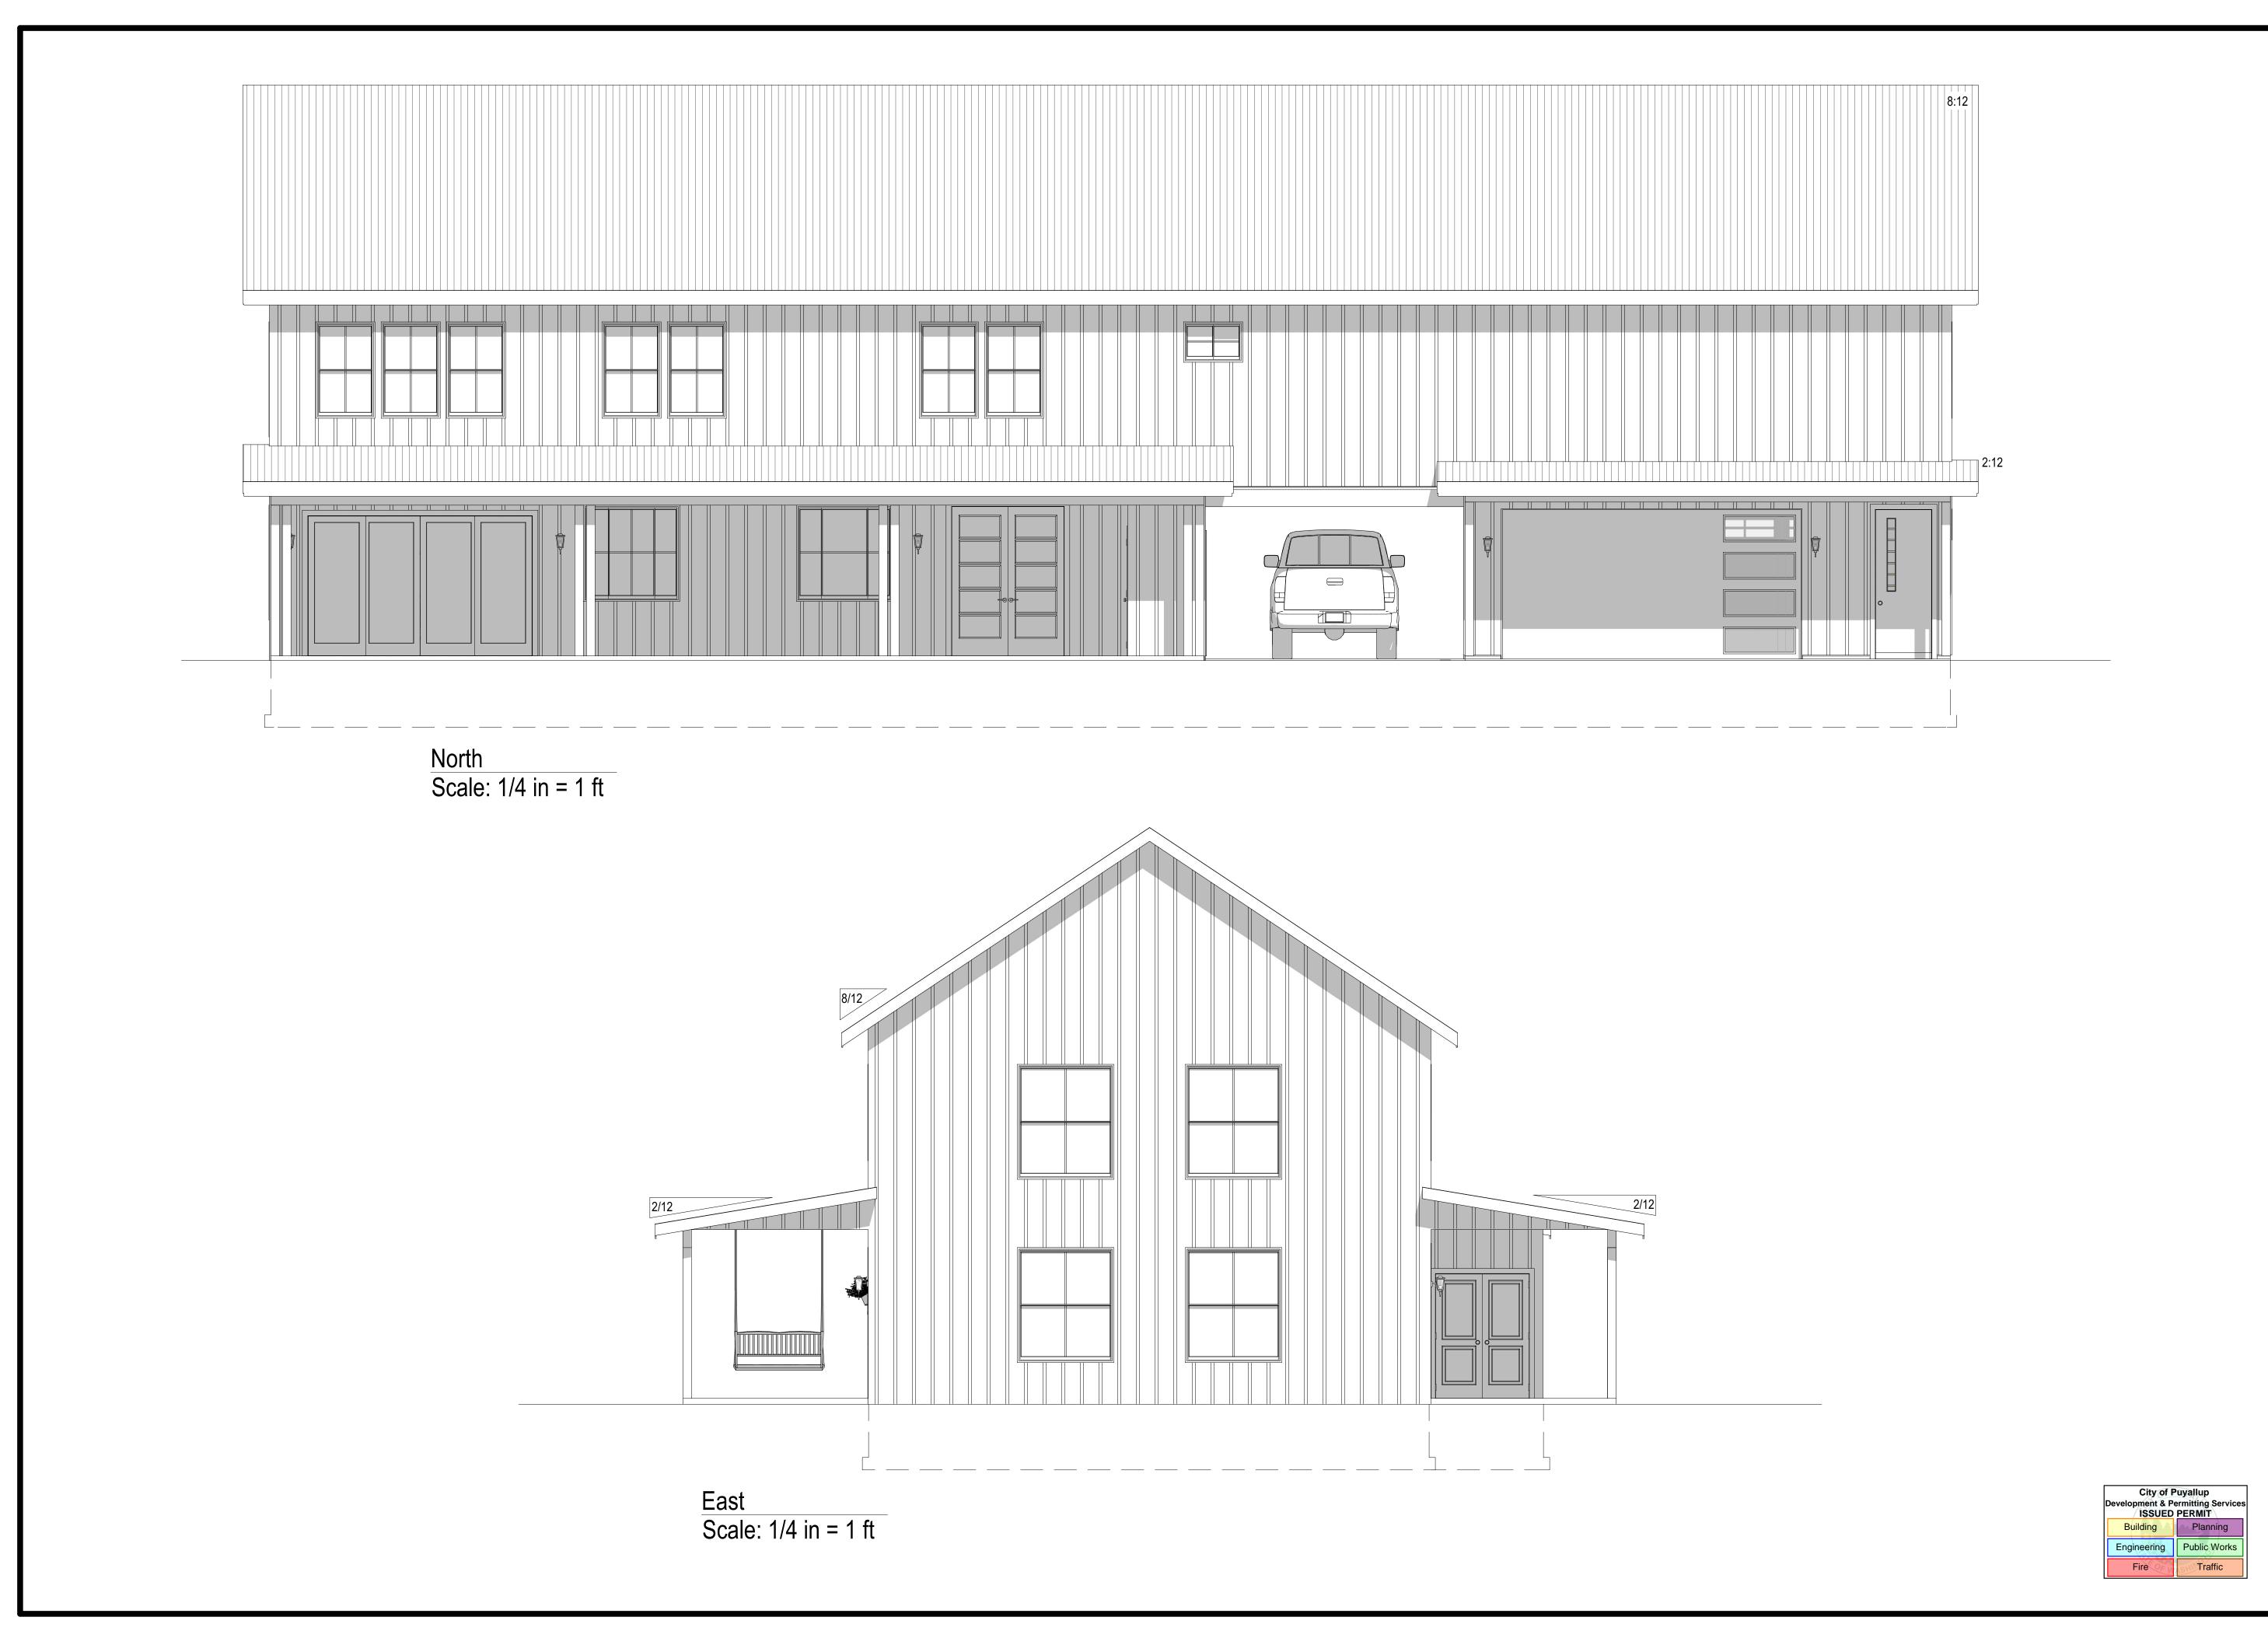


Farris, Rich & Kathy
2345 West Stewart
Puyallup, WA 98371
253-255-3413
Parcel # - 0420207029

**Elevations** 

PHS Job #: 19.056

Printed On: 7/26/2023 18:36:48

Layout Sheet # 3 of 12

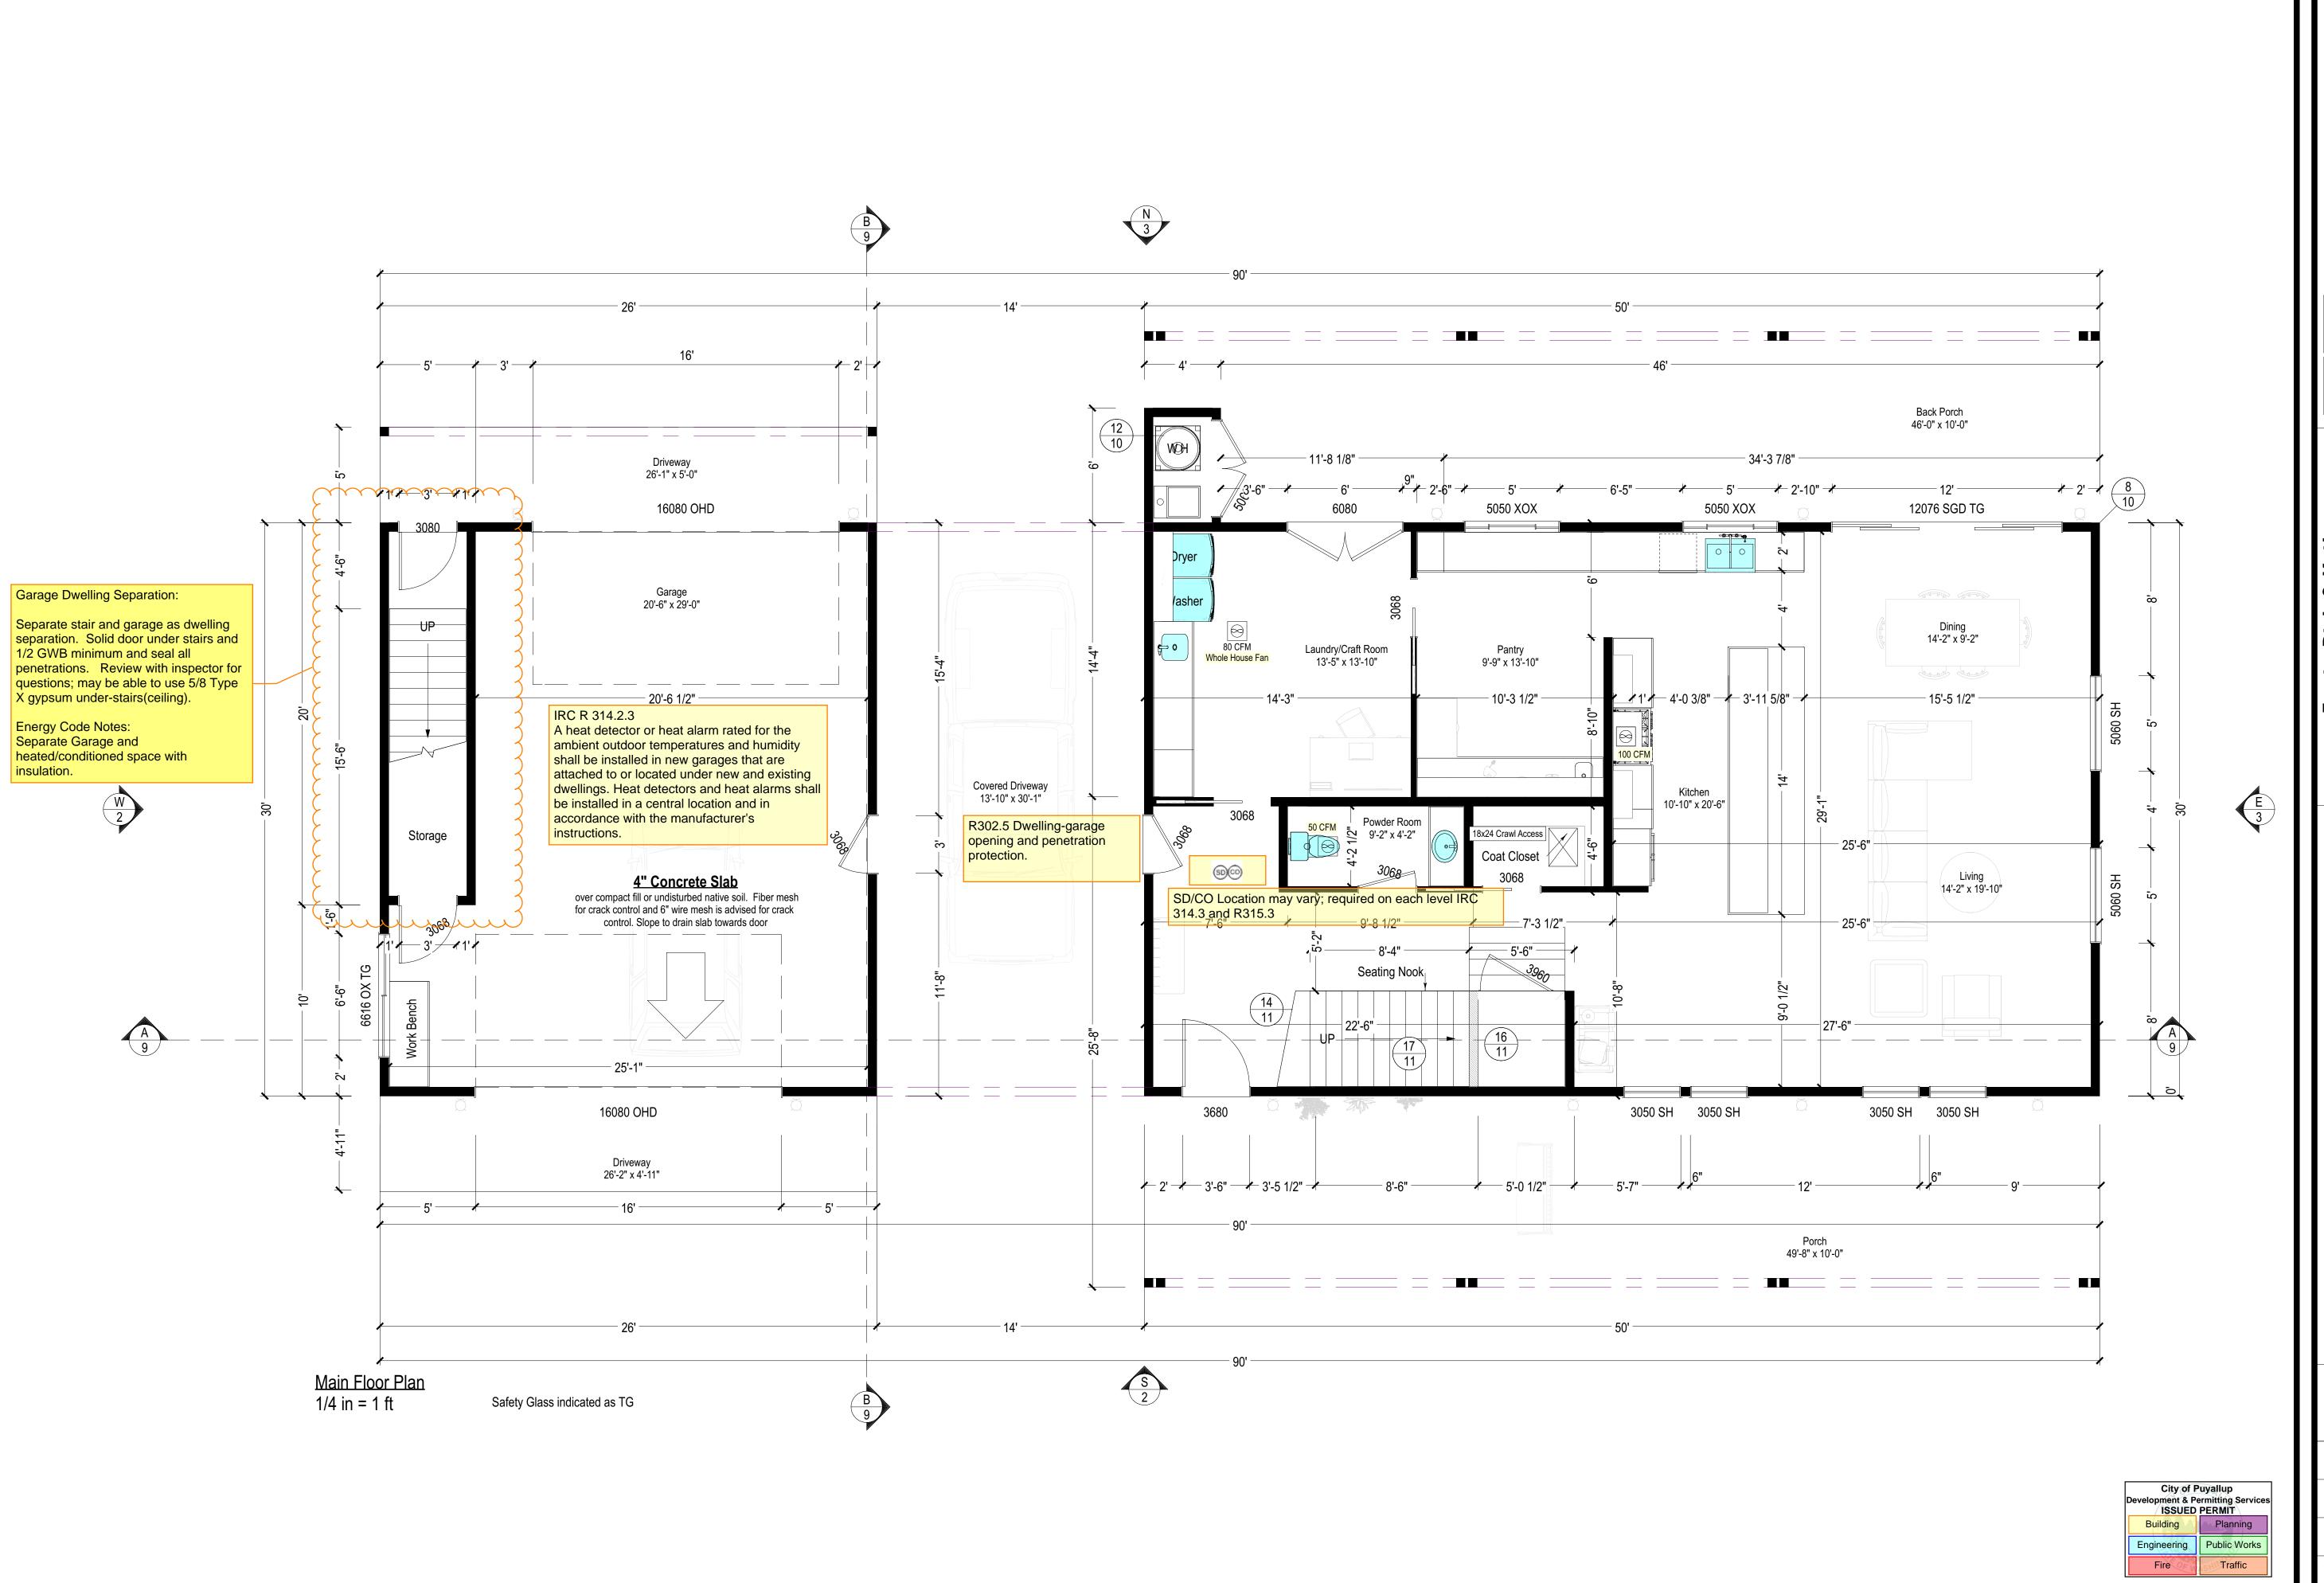


Farris, Rich & Kathy
2345 West Stewart
Puyallup, WA 98371
253-255-3413
Parcel # - 0420207029

Main Floor

PHS Job #: 19.056

Printed On: 7/26/2023 18:36:48 Layout Sheet #

4 of 12

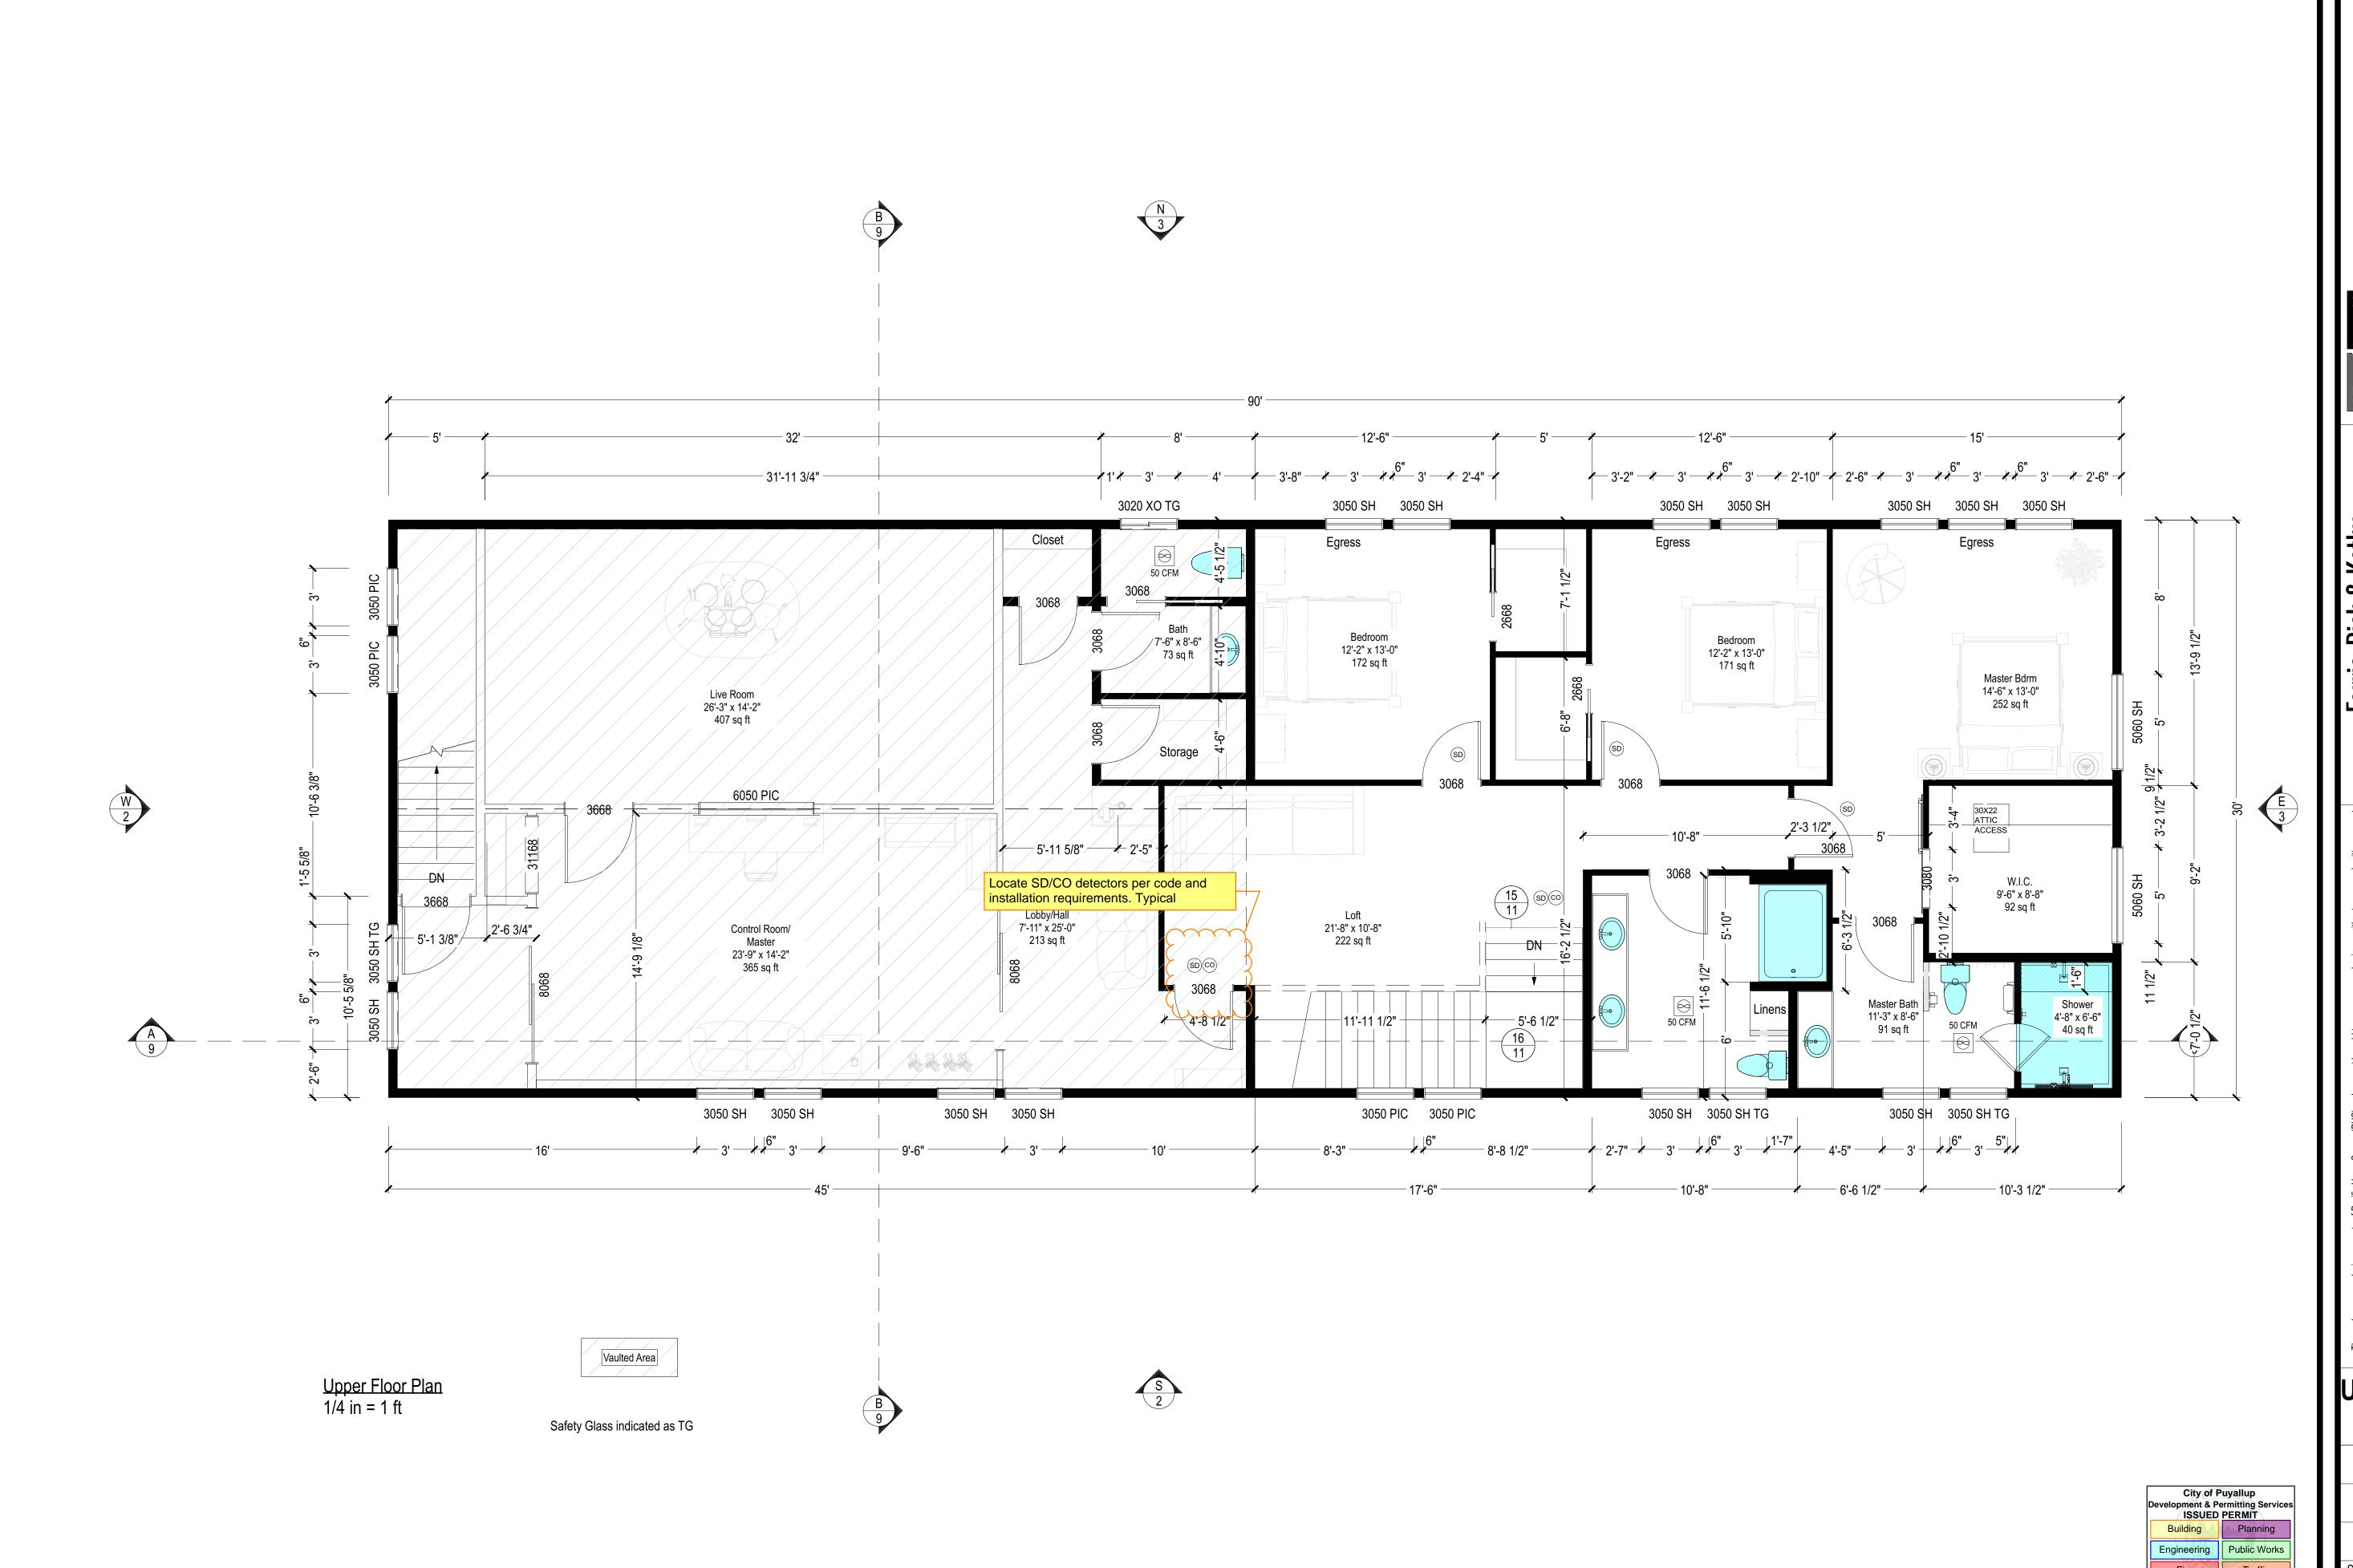

HACI HOUS SOUF

Farris, Rich & Kathy
2345 West Stewart
Puyallup, WA 98371
253-255-3413
Parcel # - 0420207029

s, Rich & Kathy and to be built on the customer's site at 2345 West scaled measurements.

I scaled measurements.

I section as an "architectural work" under sec. 102 of the copyright act, do to the overall form as well as the arrangement and composition of e of these plans, the design in whole or part, can legally result in

198371.

198371.

198371.

198371.

198371.

198372.

198372.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.

198373.


198

Upper Floor

PHS Job #: 19.056

Printed On: 7/26/2023 18:36:48

Layout Sheet # 5 of 12

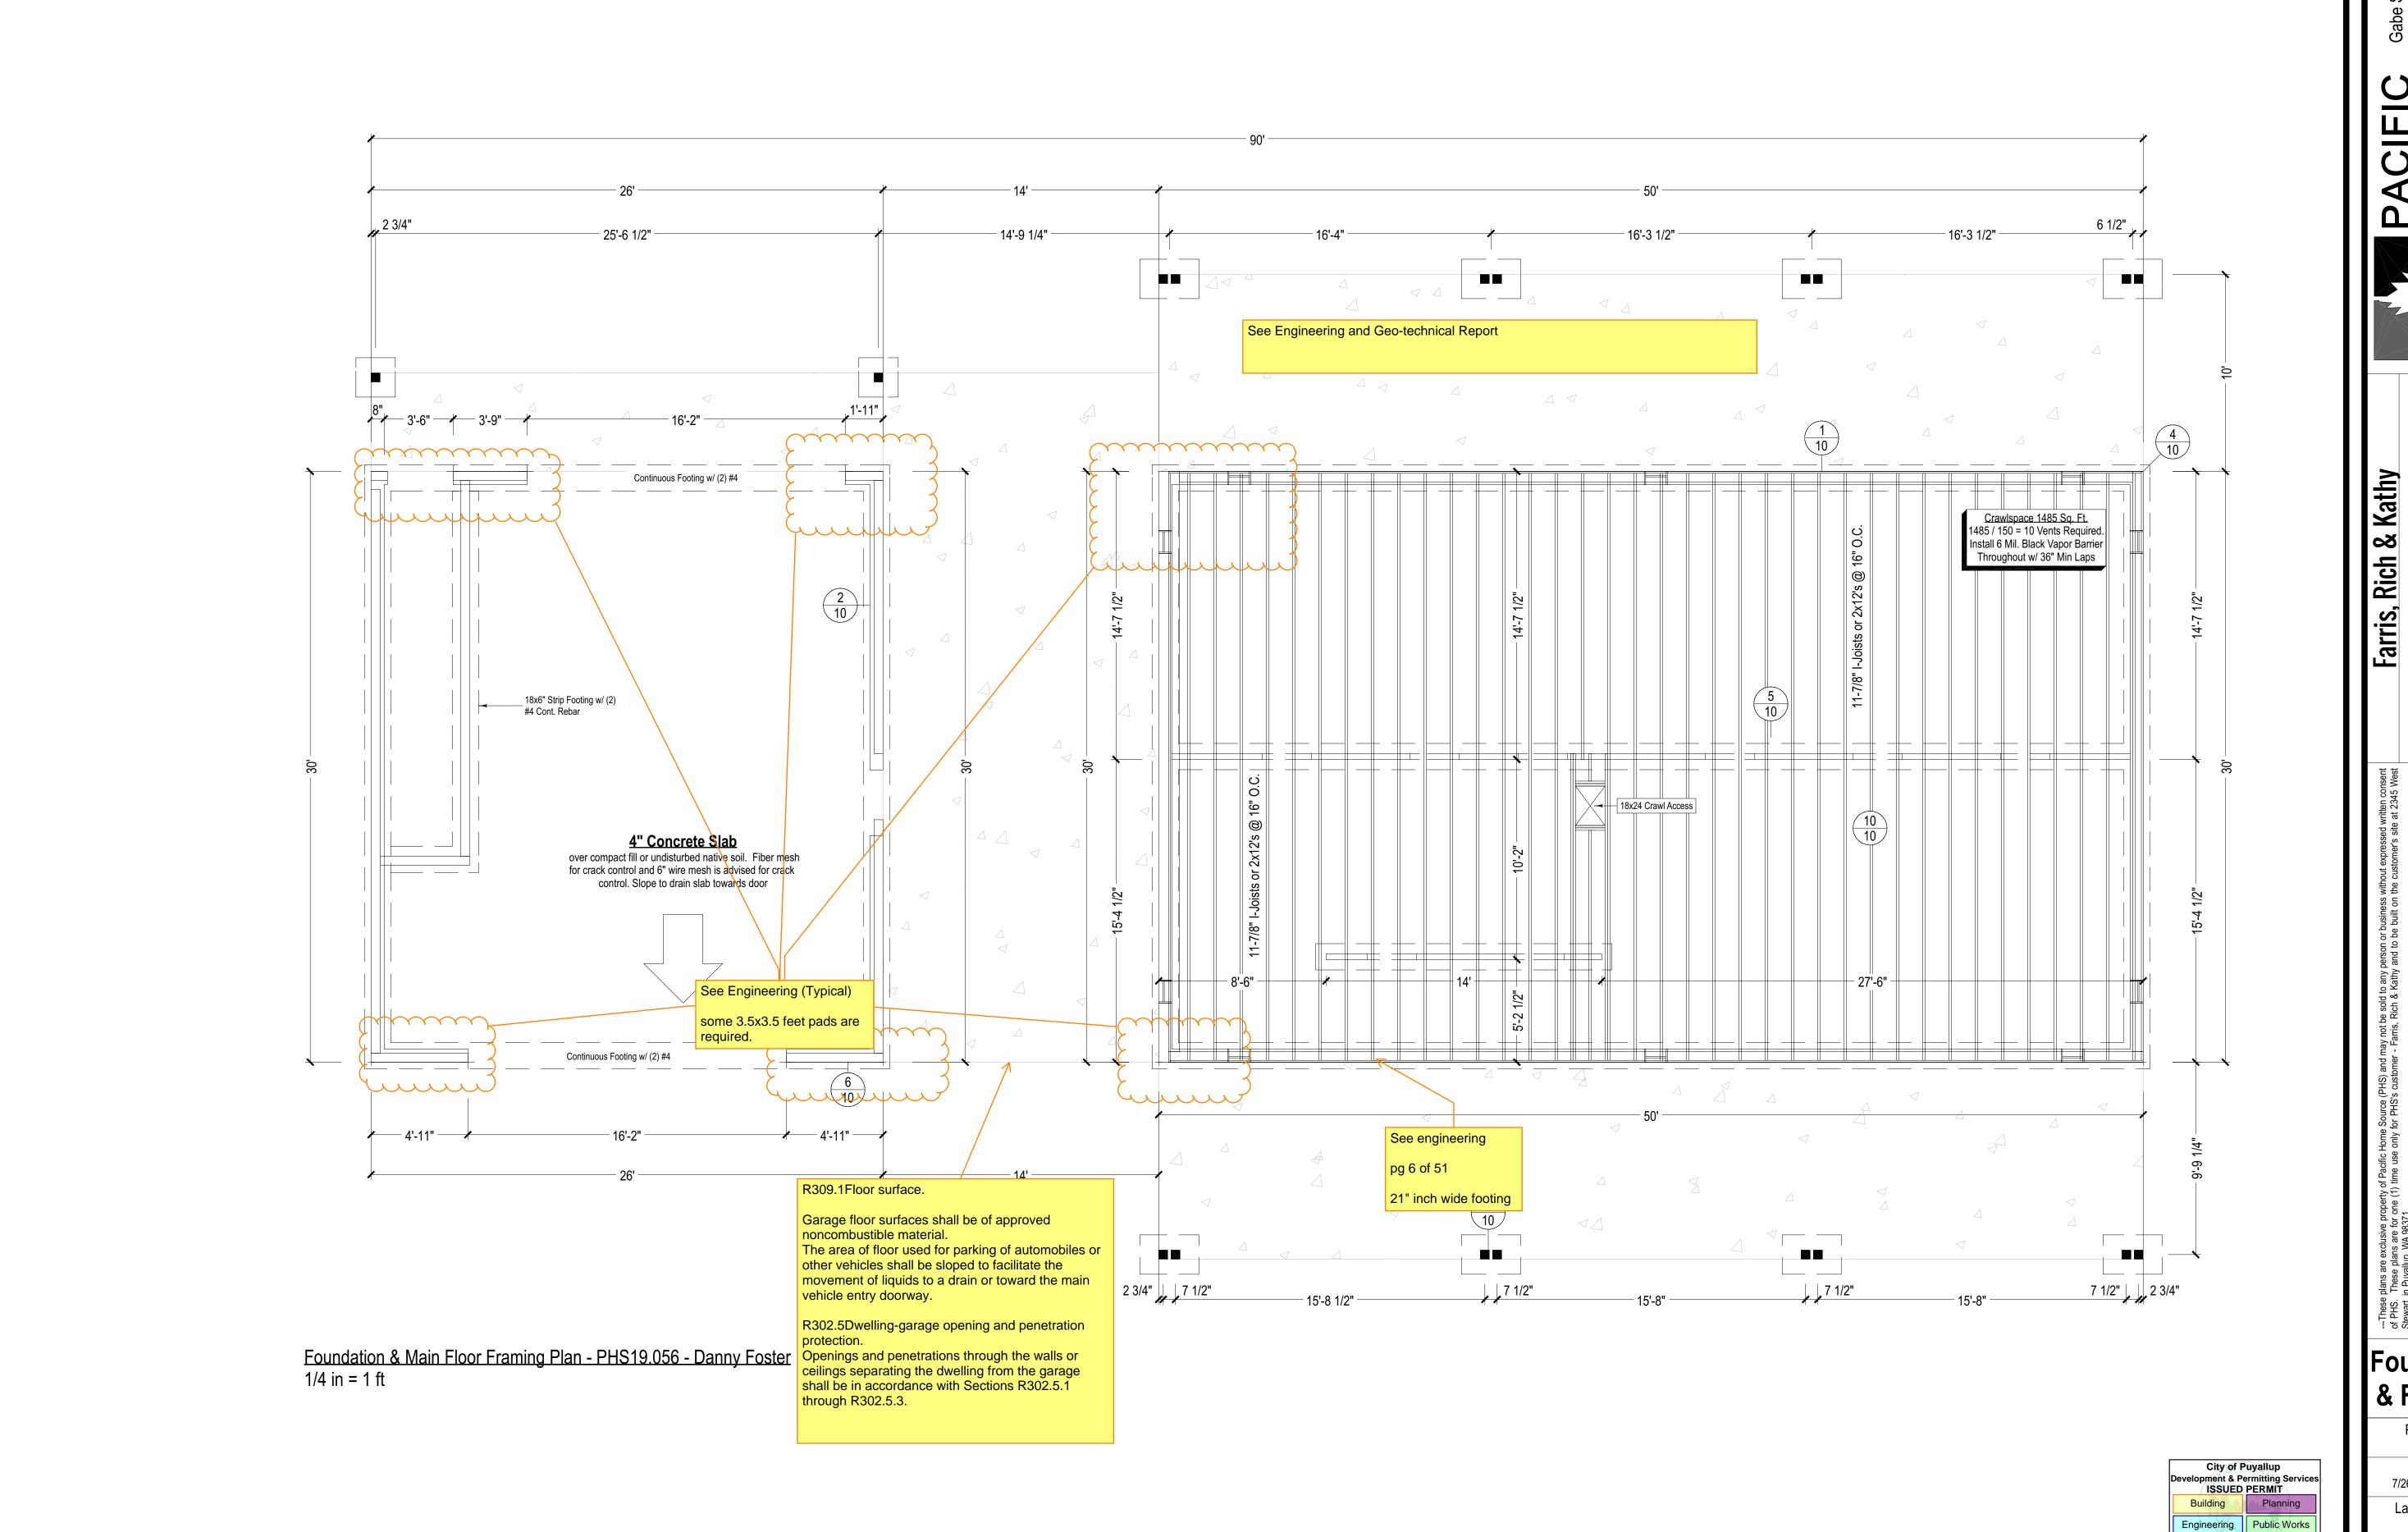

Gabe Spruell
Ph: 253.312.5523
4001 72nd St. E.
Tacoma, WA 98443

HOI SOUF

2345 West Stewart

be built on the customer's site at 2345 West all work" under sec. 102 of the copyright act, well as the arrangement and composition of esign in whole or part, can legally result in redesign changes to these plans.

i (1) time use only for PHS's customer - Farris, Rich & Kathy and to be built written dimensions on this plan supersede any scaled measurements.
e copyrighted and are subject to copyright protection as an "architectural worl 1990. The protection includes but is not limited to the overall form as well as Under such protection, any unauthorized use of these plans, the design i Aritten permission must be obtained and granted prior to any use and/or design.

Stewart in Puyallup, WA 98371.

--NOTICE: DO NOT SCALE - The writth recompanying the notice: these plans are copyright notice: these plans are copyright and elements of design. Under monetary compensation to PHS. Writte recompany variations from conditions and of the conditions and other properties.


# Foundation & Framing

PHS Job #: 19.056

Printed On: 7/26/2023 18:36:48

Layout Sheet #

6 of 12

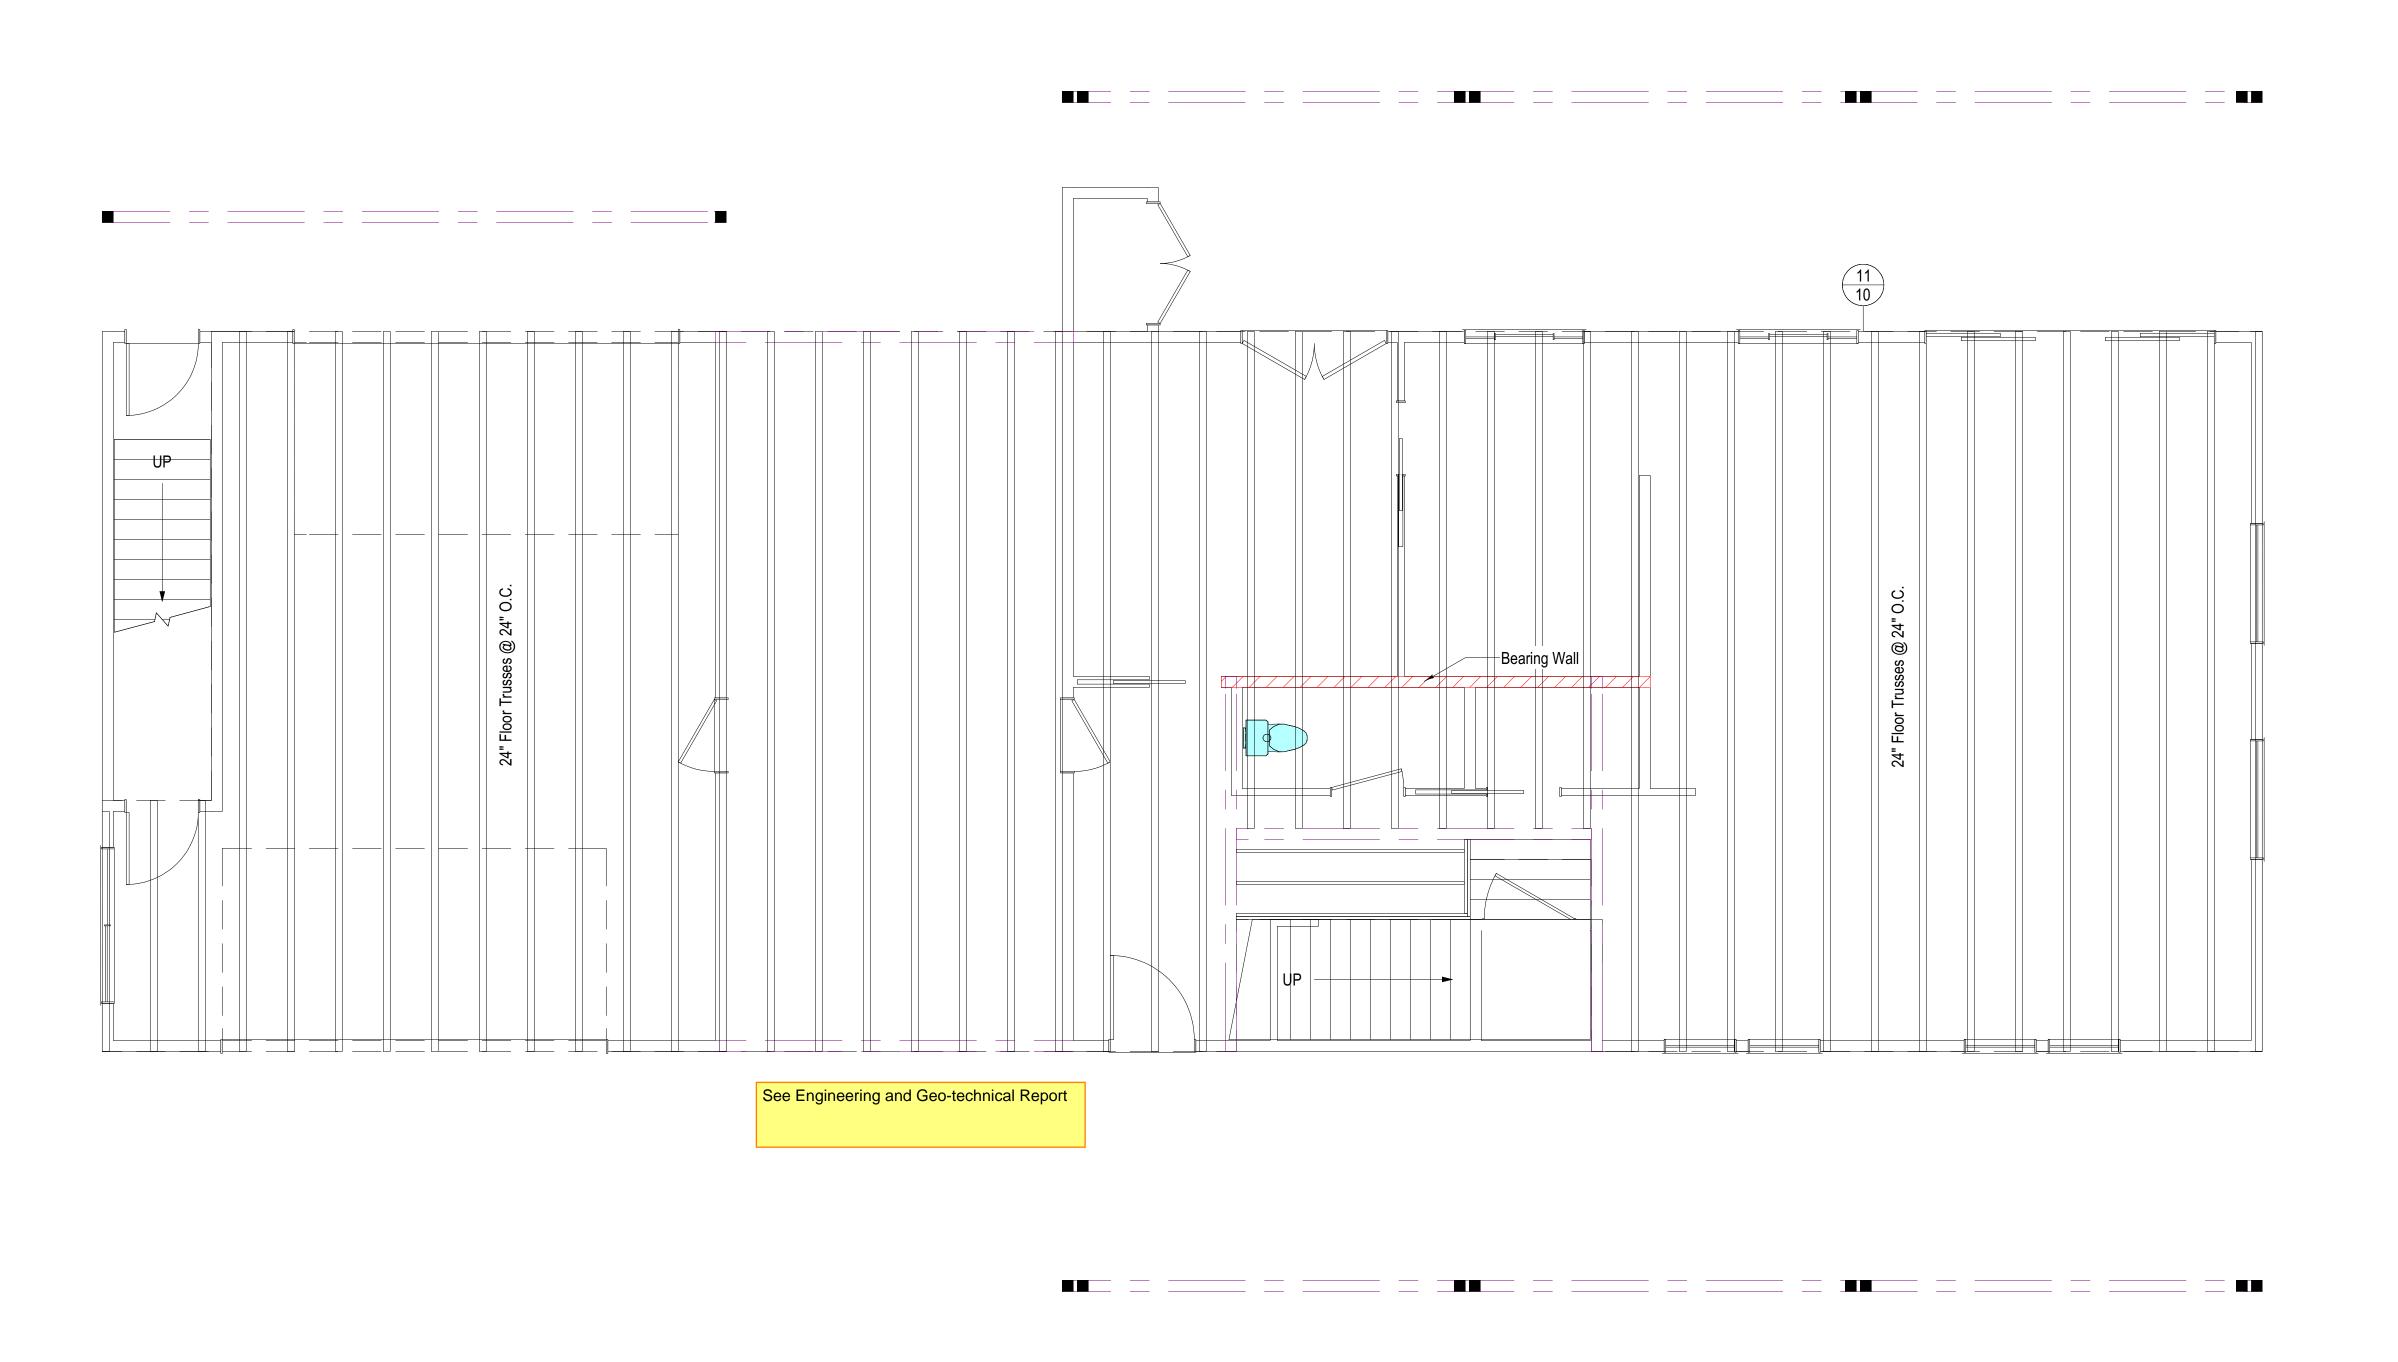

<u>Upper Floor Framing Plan - PHS19.056 - Danny Foster</u> 1/4 in = 1 ft

Farris, Rich & Kathy
2345 West Stewart
Puyallup, WA 98371
253-255-3413
Parcel # - 0420207029


Upper Floor Framing

PHS Job #: 19.056 Printed On: 7/26/2023 18:36:48

City of Puyallup elopment & Permitting Service ISSUED PERMIT

Engineering Public Works

Layout Sheet # 7 of 12

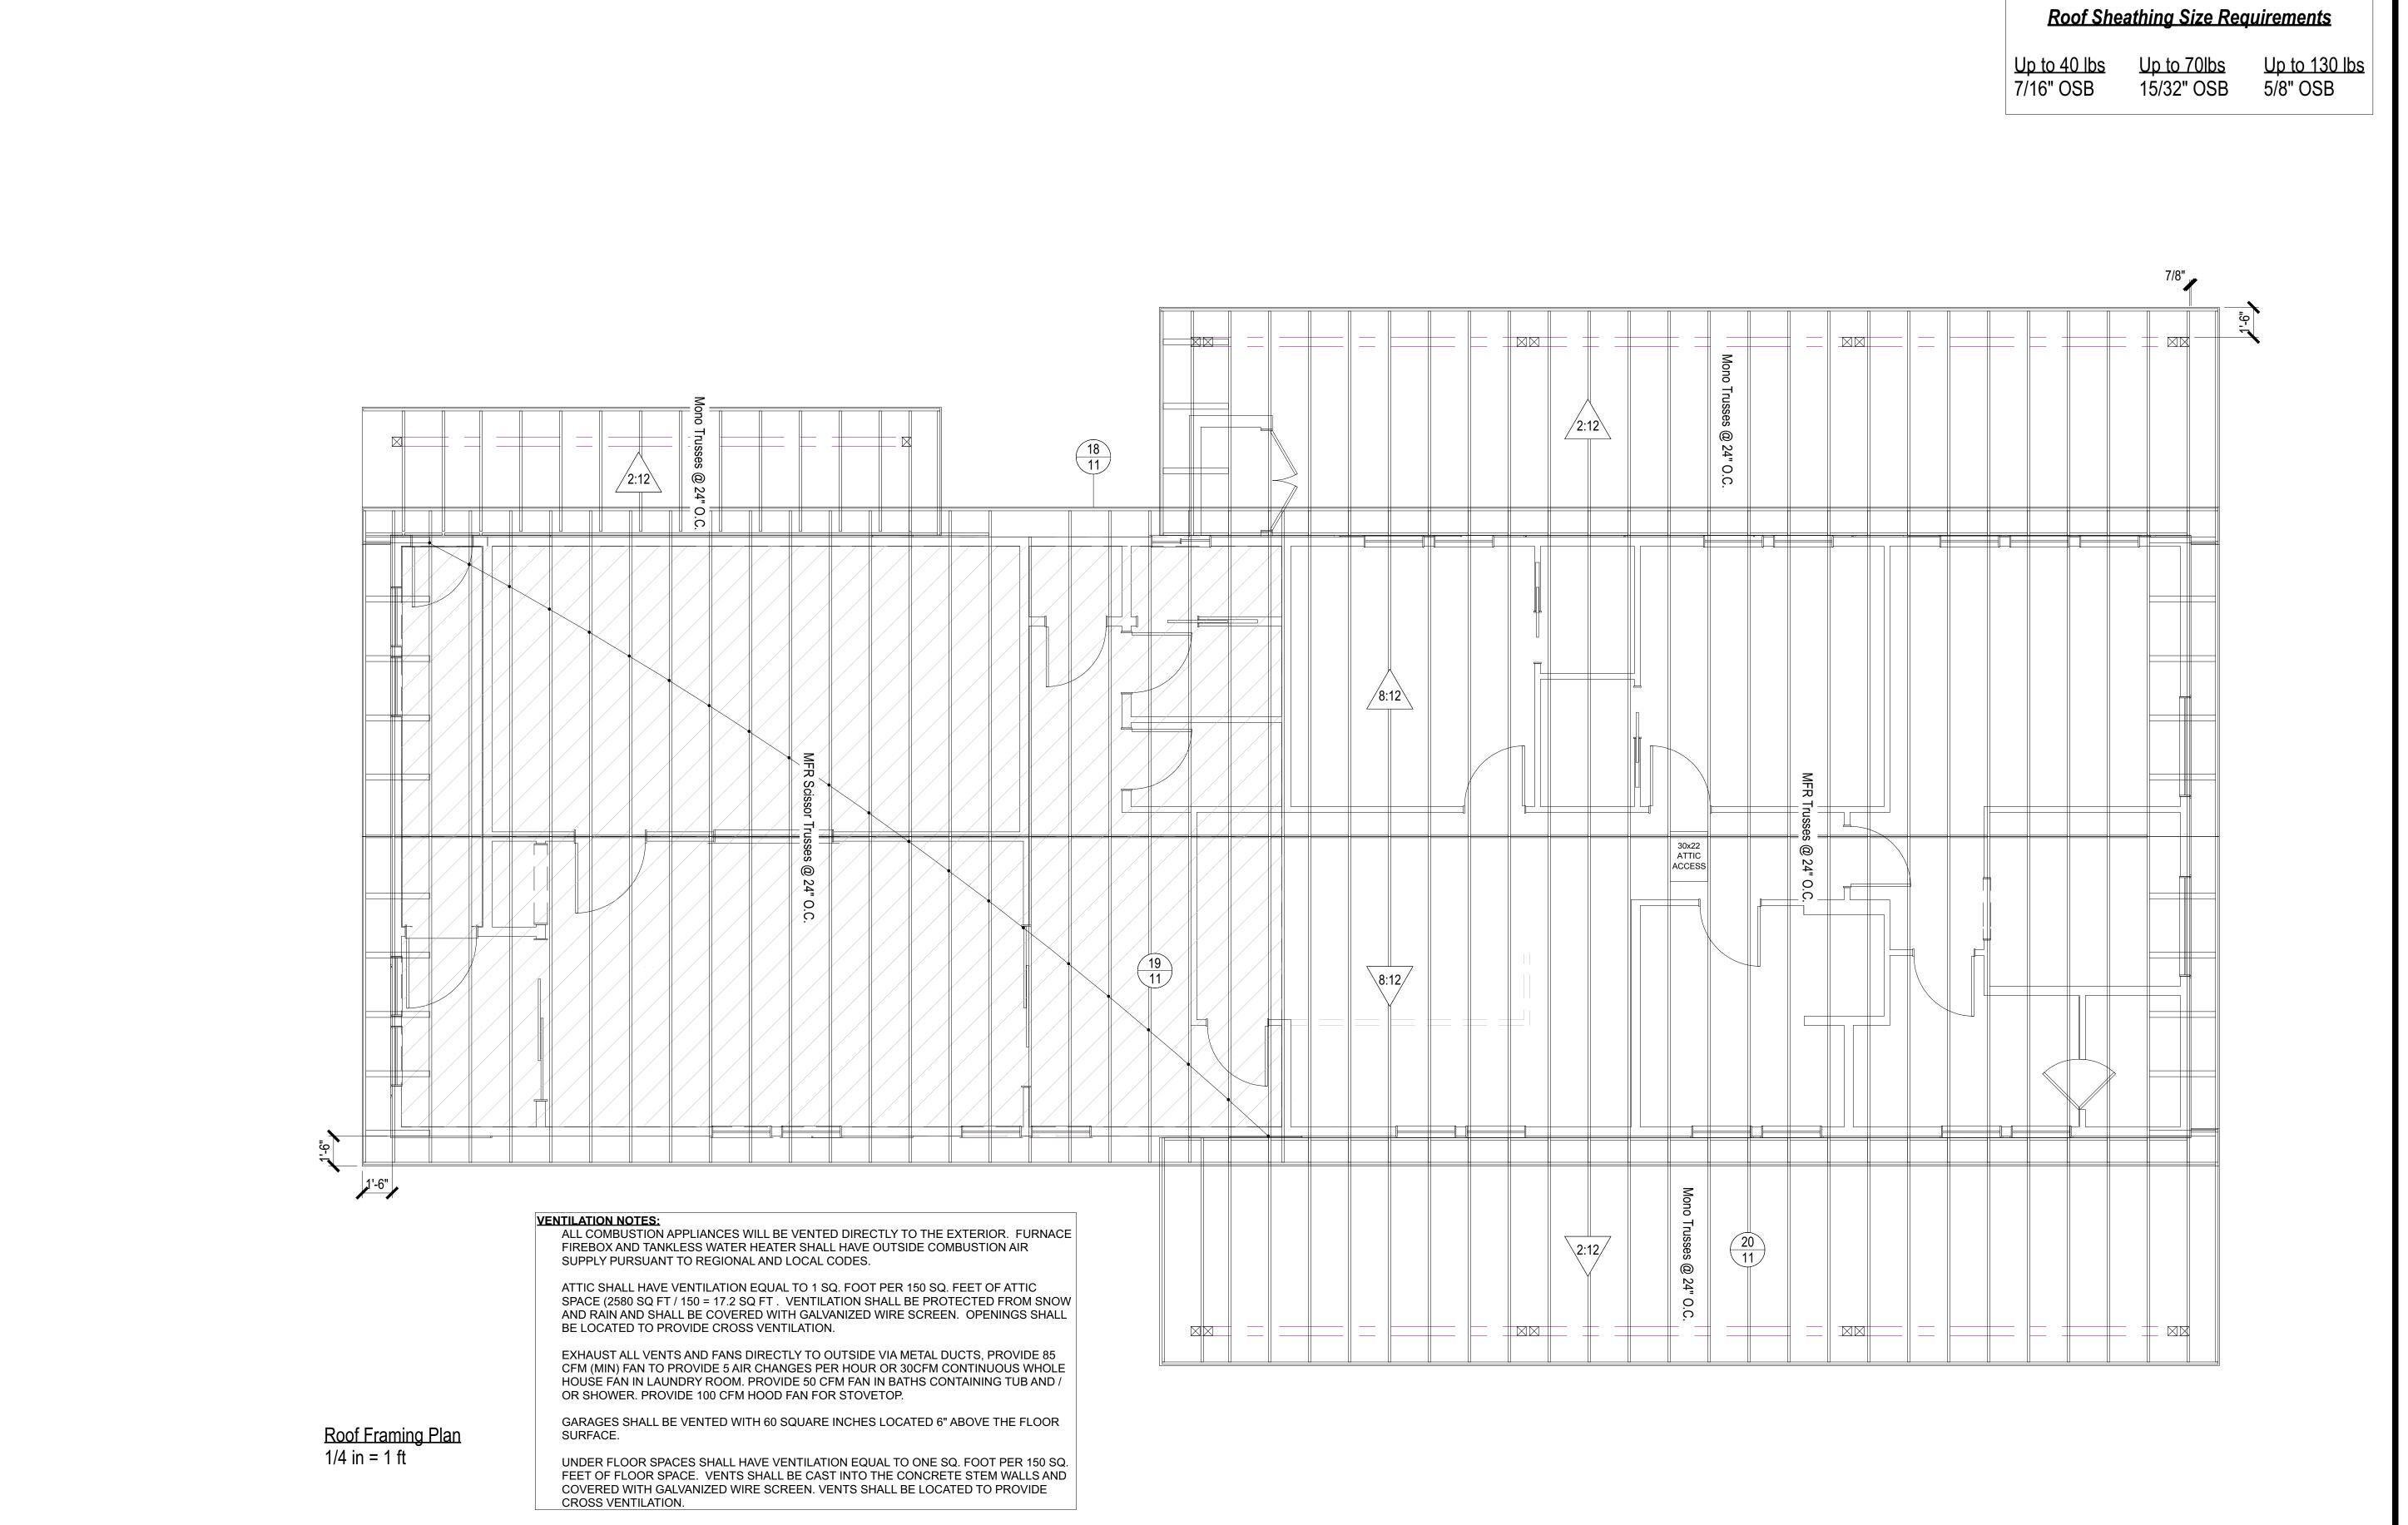

City of Puyallup
Development & Permitting Services
ISSUED PERMIT
Building Planning
Engineering Public Works
Fire Traffic

be Spruell 53.312.5523 72nd St. E.

Gabe Spru
Ph: 253.312.3

PACIFIC HOME SOURCE



Farris, Rich & Kathy
2345 West Stewart
Puyallup, WA 98371
253-255-3413
Parcel # - 0420207029

nd to be built on the customer's site at 2345 West nents.

nitectural work" under sec. 102 of the copyright act, rm as well as the arrangement and composition of the design in whole or part, can legally result in

y for PHS'S customer - Farirs, Rich & Natry and to be built on the custom so on this plan supersede any scaled measurements. I are subject to copyright protection as an "architectural work" under sec. 1 tion includes but is not limited to the overall form as well as the arrangem tection, any unauthorized use of these plans, the design in whole or par must be obtained and granted prior to any use and/or design changes to the statement and statements.

These plans are for one (1) time use only for PH t in Puyallup, WA 98371.

ICE: DO NOT SCALE - The written dimensions on this right notice: these plans are copyrighted and are sult as amended December 1990. The protection includes and elements of design. Under such protection, any compensation to PHS. Written permission must be variations from conditions and dimensions shown or


Roof Framing

PHS Job #: 19.056

Printed On: 7/26/2023 18:36:49

Layout Sheet #

8 of 12 eet:

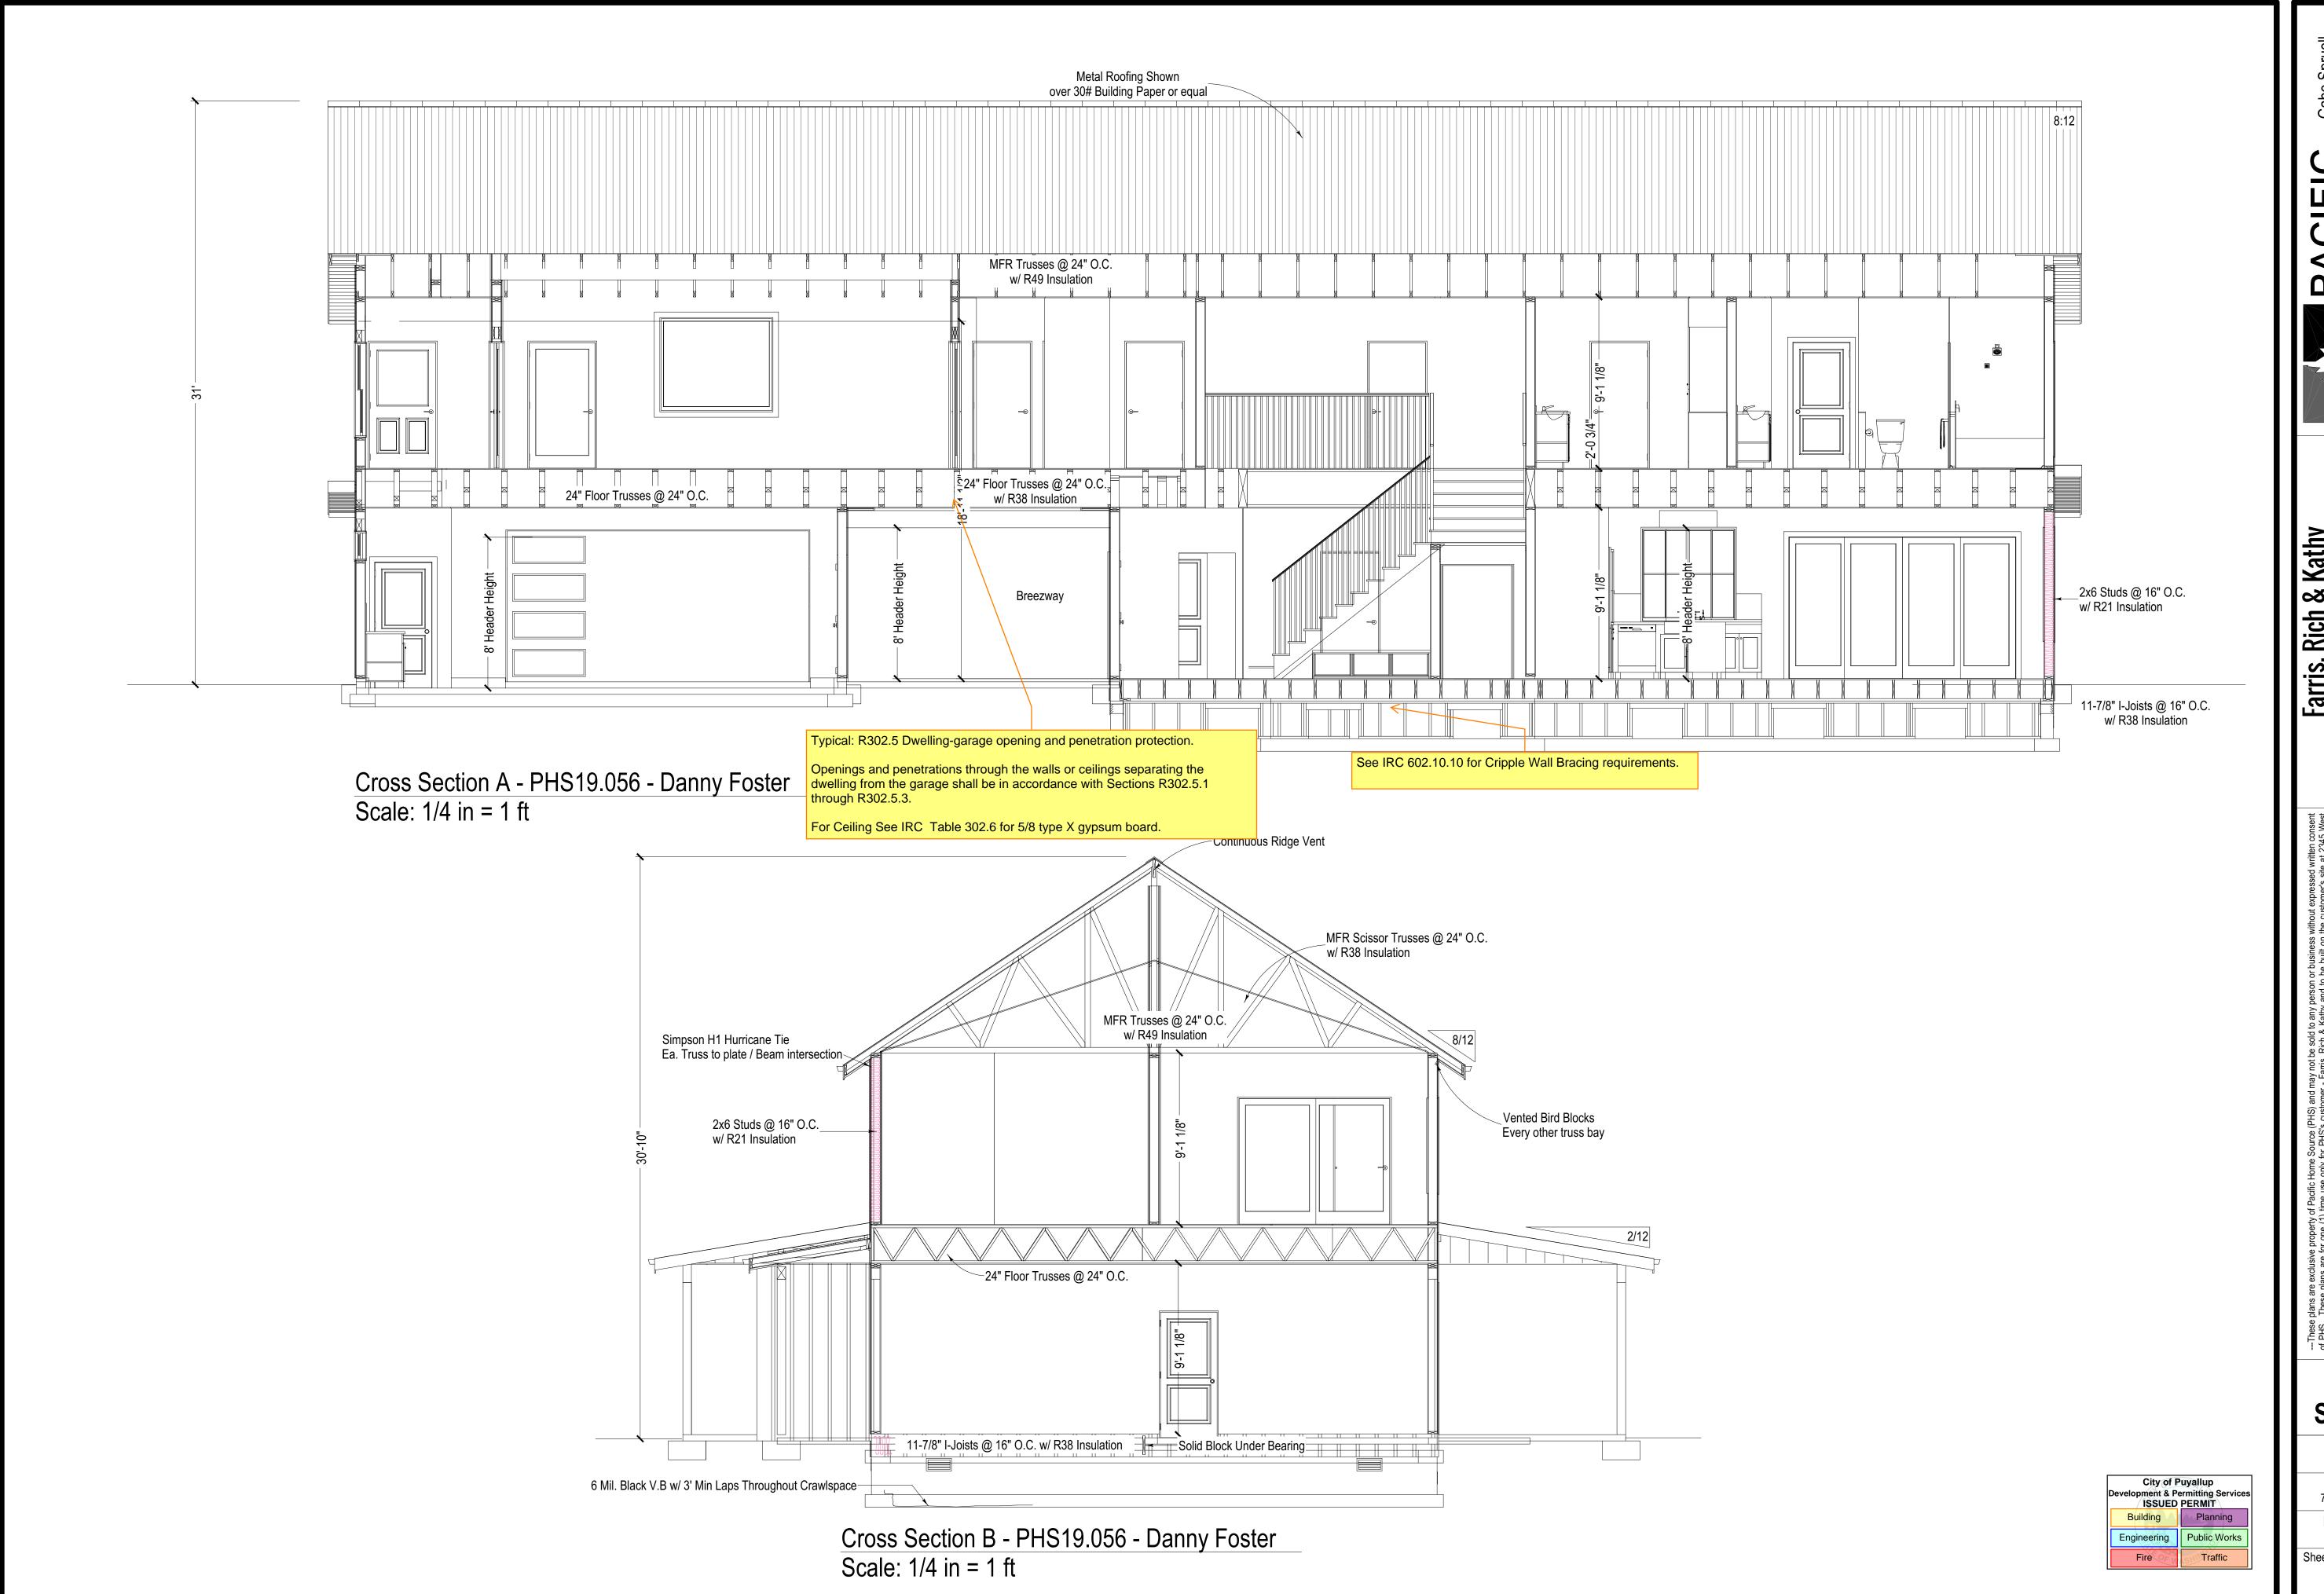

Gabe Spruell
Ph: 253.312.5523
4001 72nd St. E.
Tacoma, WA 98443

PACIFIC HOME SOURCE



Farris, Rich & Kathy
2345 West Stewart
Puyallup, WA 98371
253-255-3413
Parcel # - 0420207029

Substorner - Farris, Kich & Nathy and to be built on the customer's site at 2.345 west in supersede any scaled measurements. To copyright protection as an "architectural work" under sec. 102 of the copyright act, but is not limited to the overall form as well as the arrangement and composition of unauthorized use of these plans, the design in whole or part, can legally result in ained and granted prior to any use and/or design changes to these plans.

Stewart in Puyallup, WA 98371.

--NOTICE: DO NOT SCALE - The written dimensions
--Copyright notice: these plans are copyrighted and a
17 USC as amended December 1990. The protectio
spaces and elements of design. Under such protec
monetary compensation to PHS. Written permission in
--Any variations from conditions and dimensions should be a such protection of the protect


Cross Sections


PHS Job #:

19.056

Printed On: 7/26/2023 18:36:49

Layout Sheet # 9 of 12

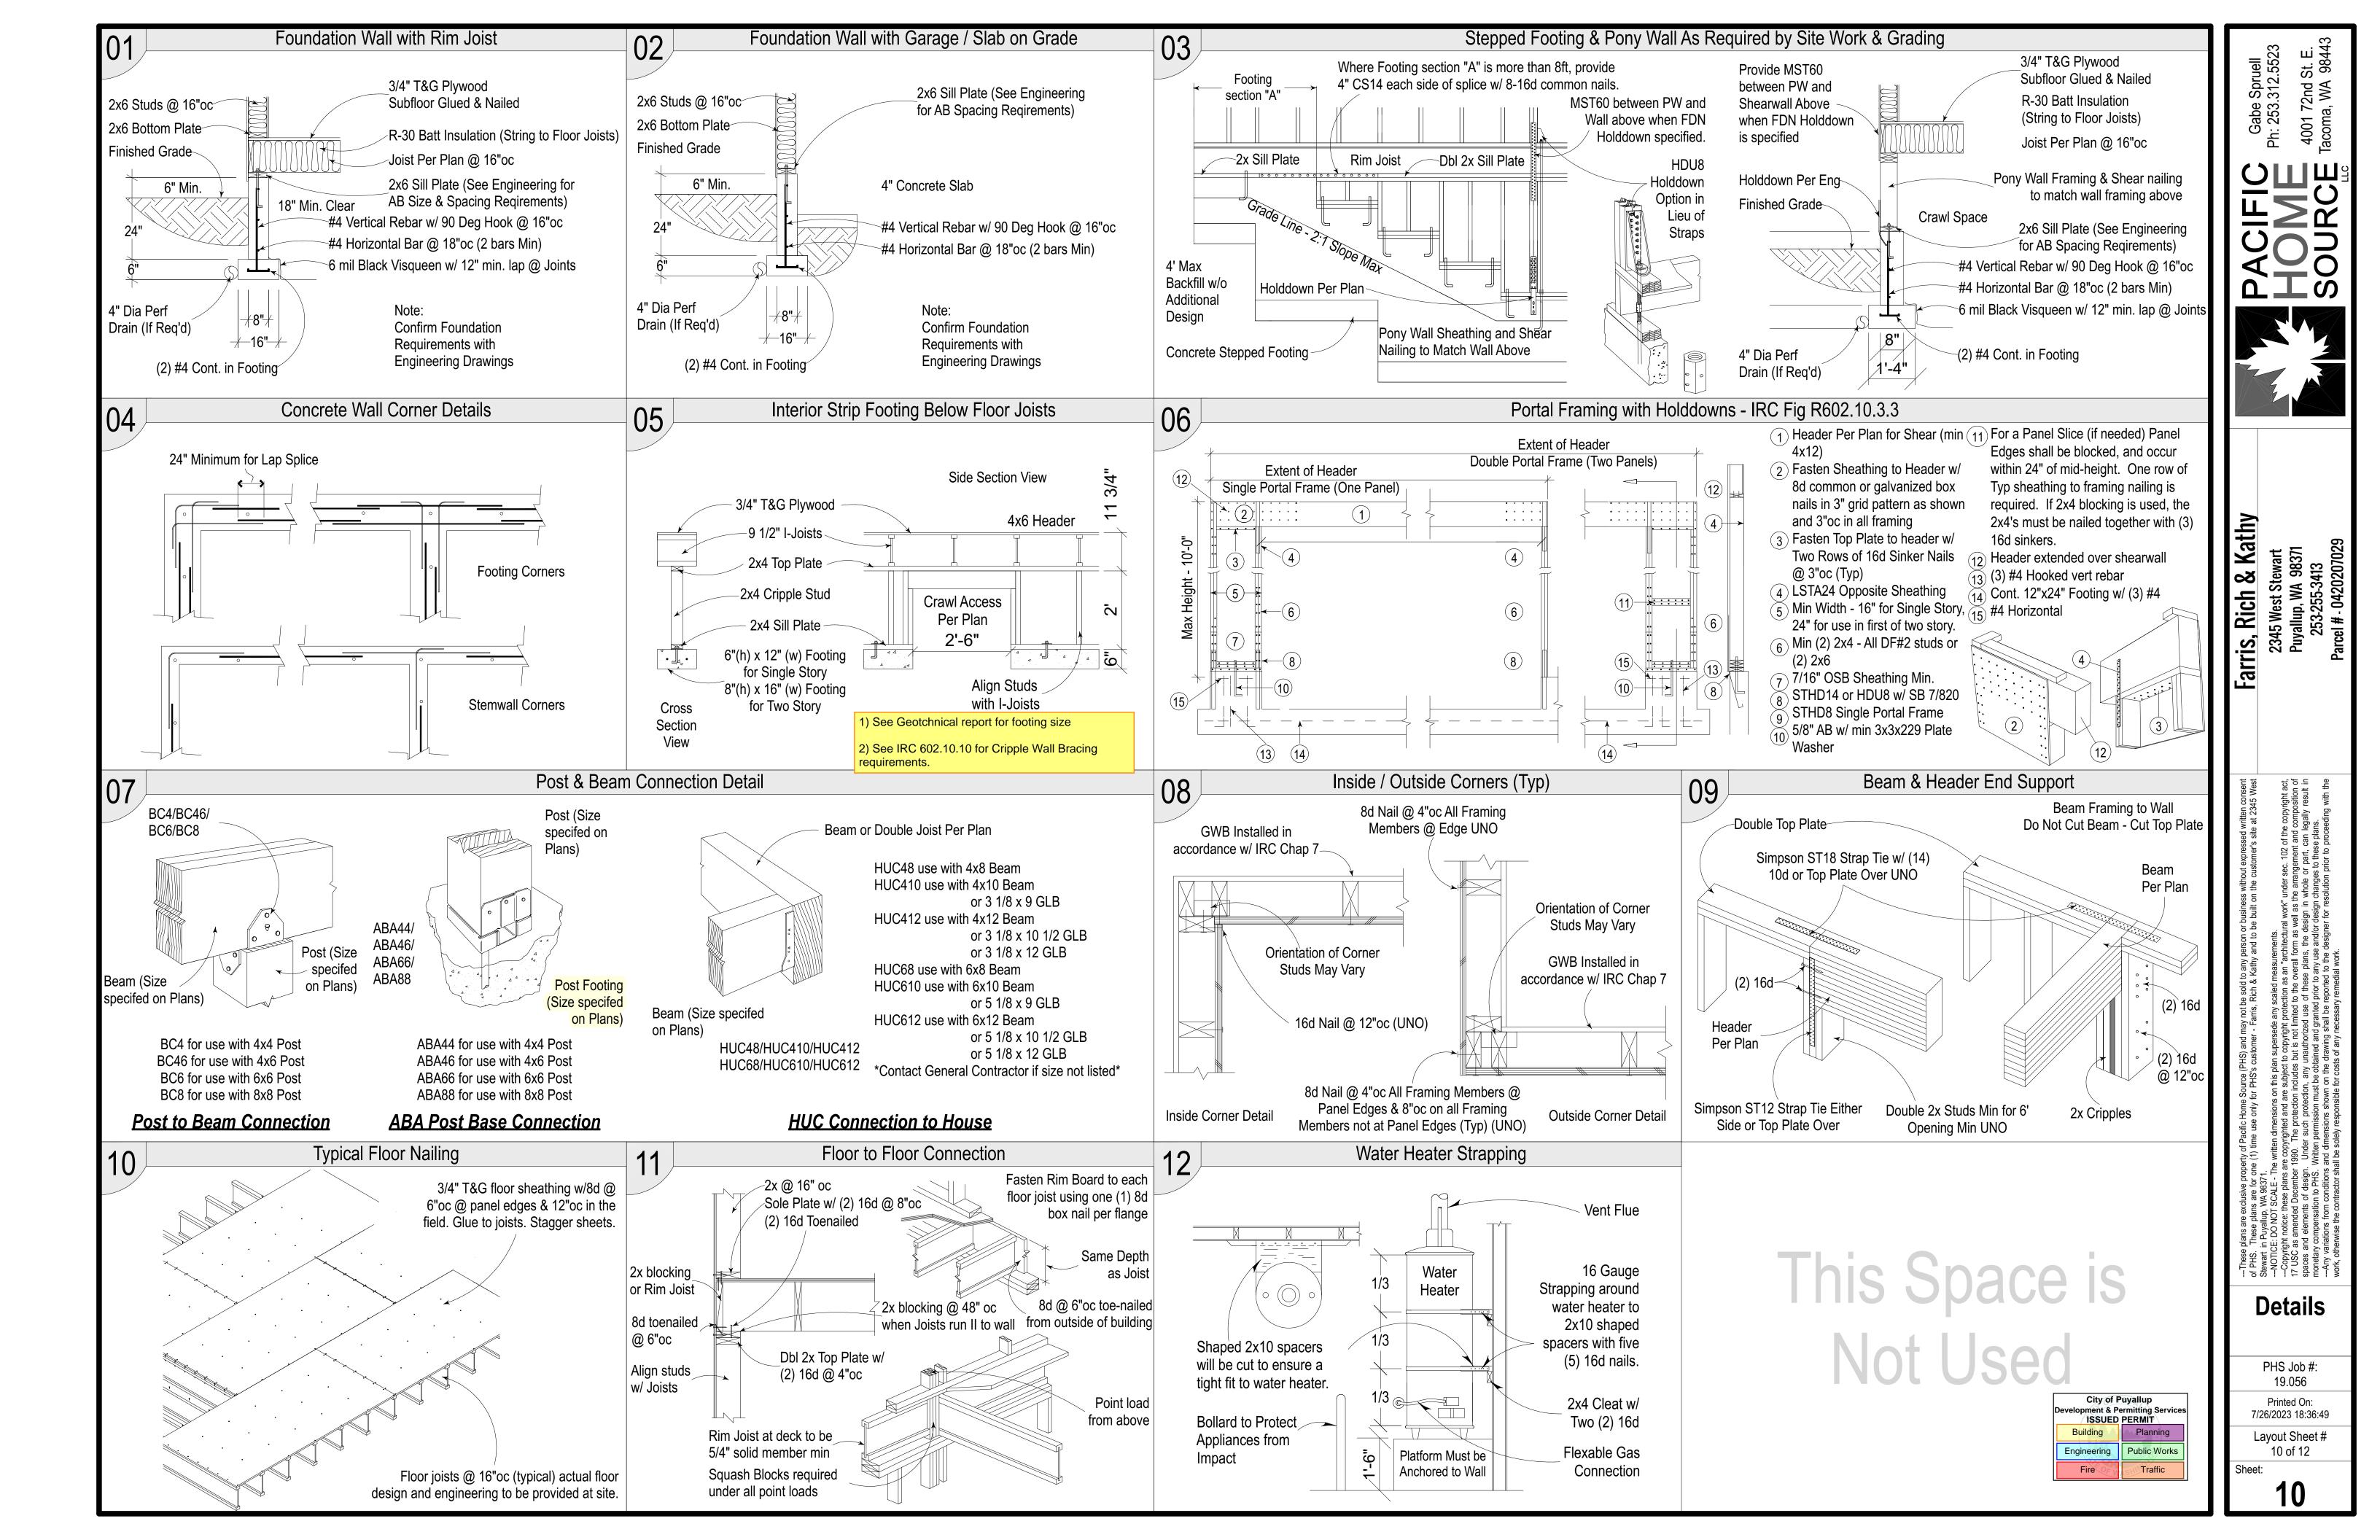

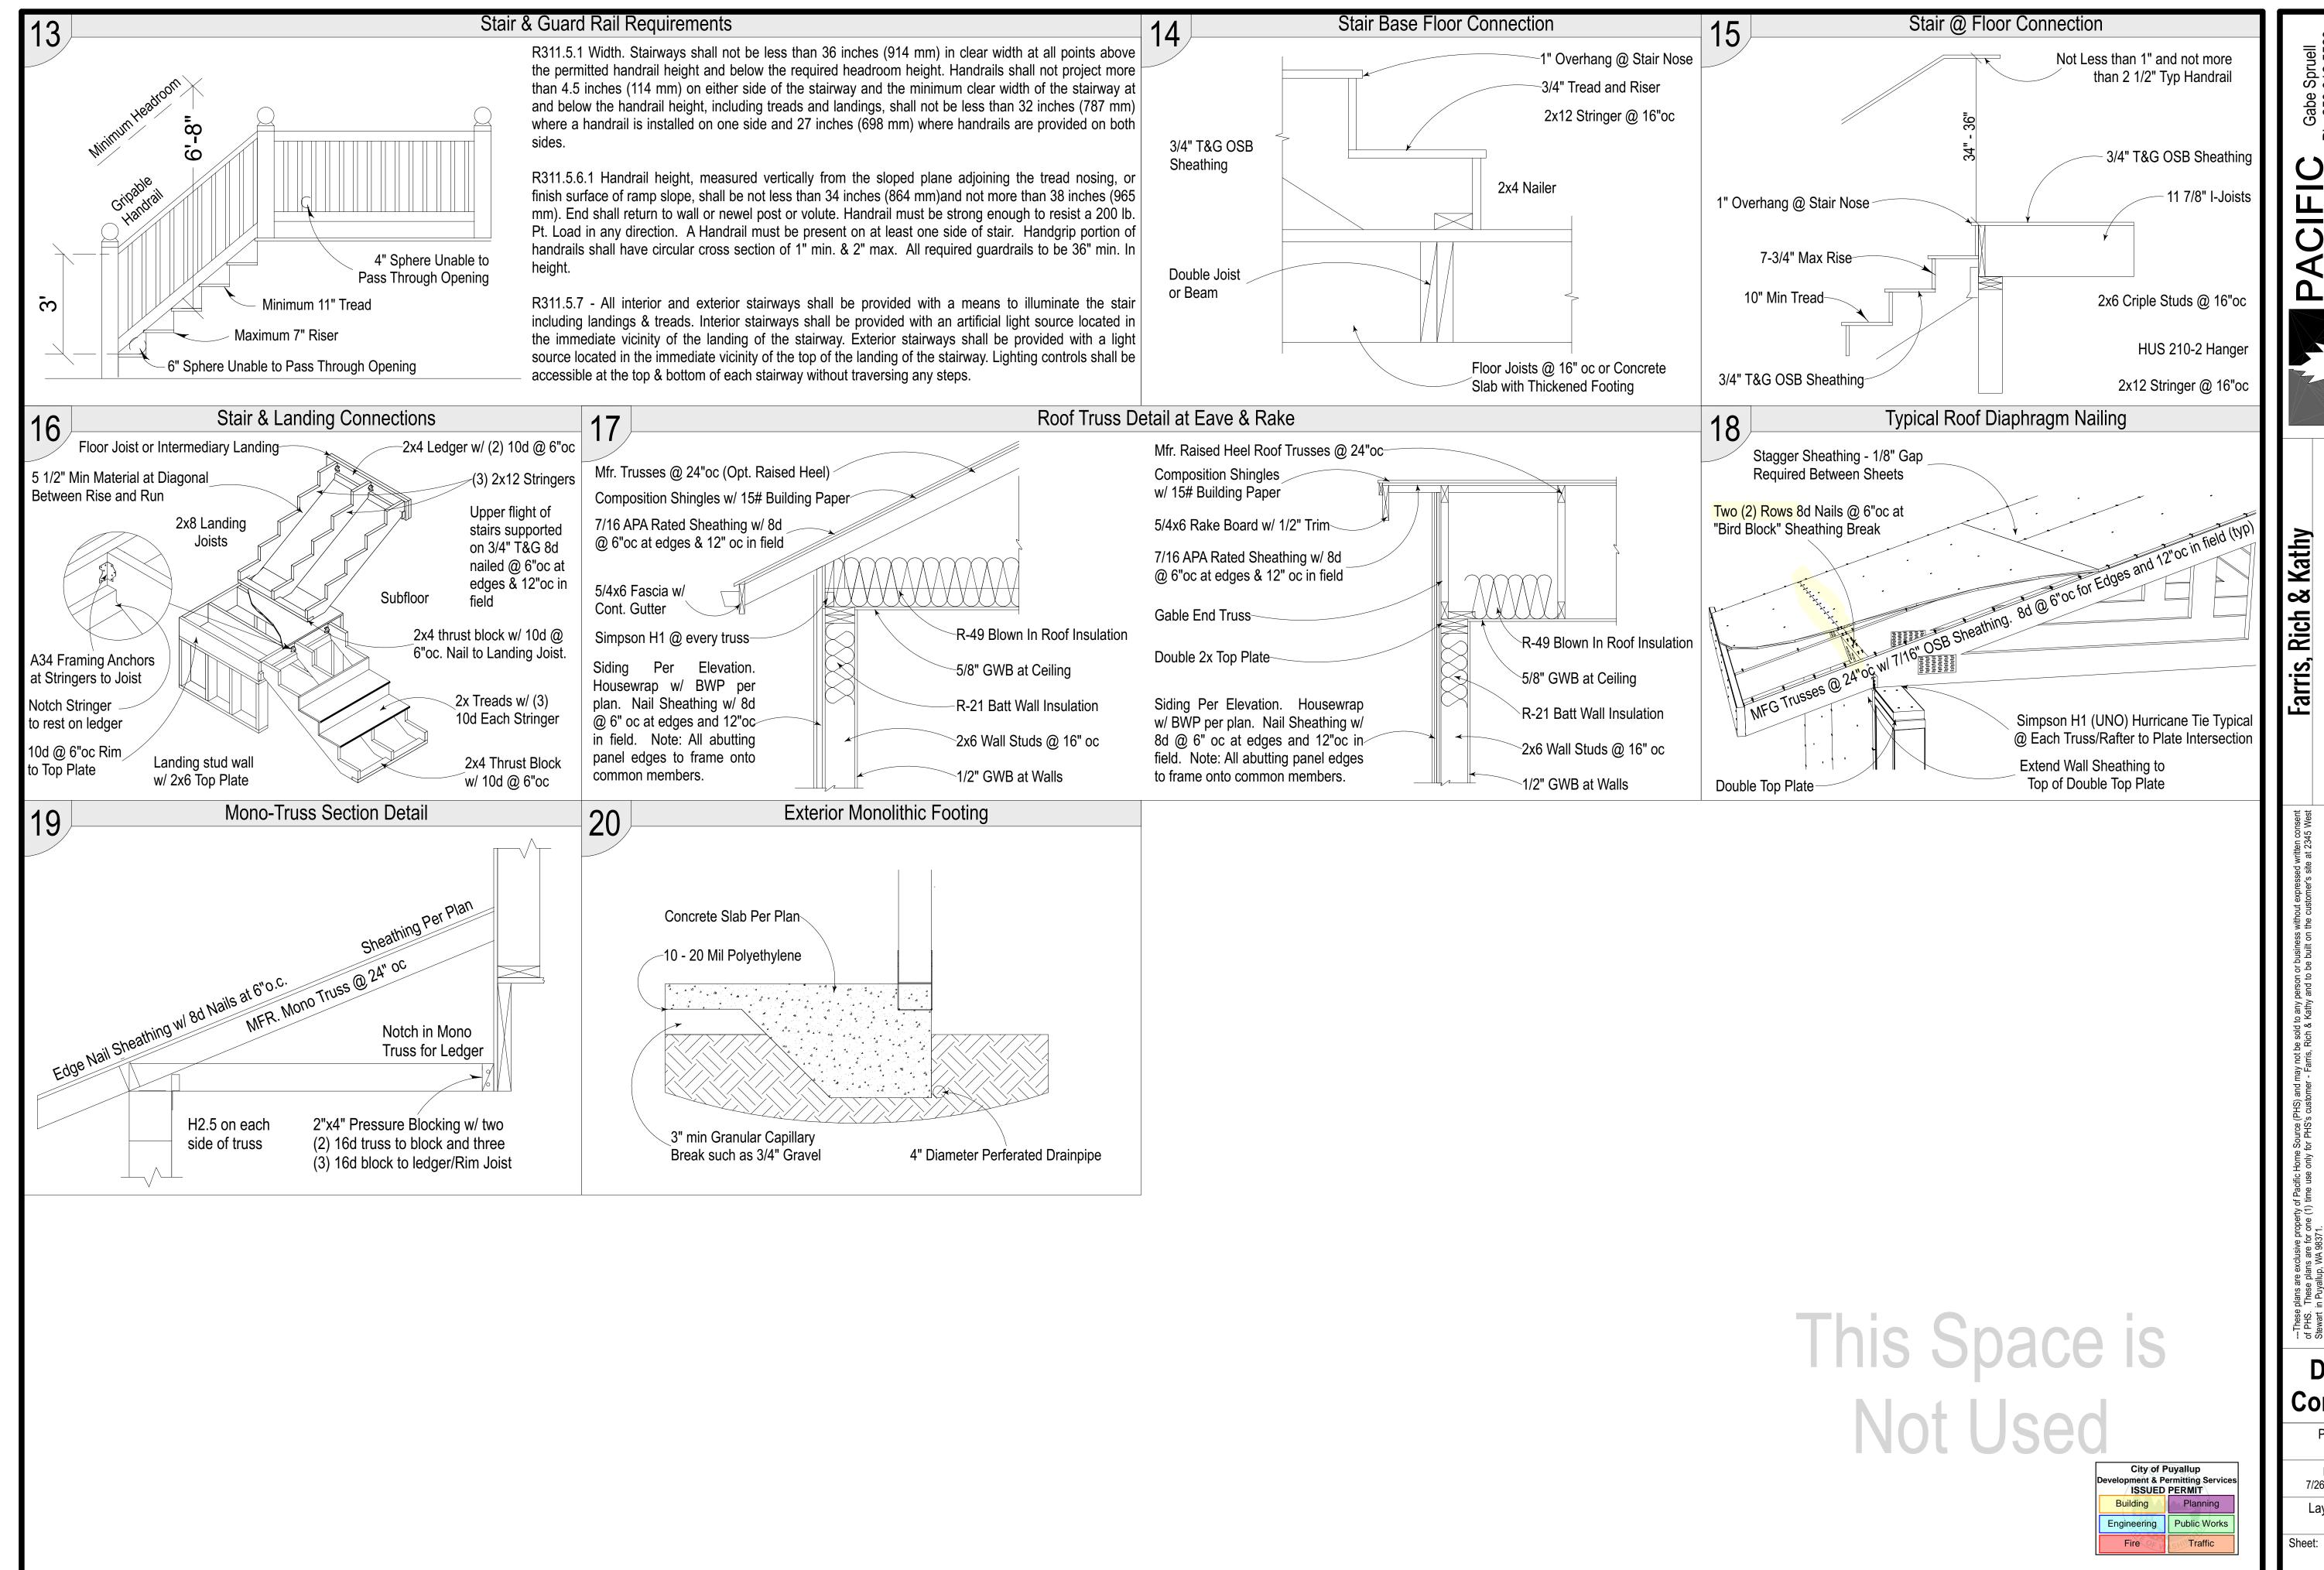

E. 1443

**Details** Continued

PHS Job #: 19.056

Printed On: 7/26/2023 18:36:50 Layout Sheet # 11 of 12

- 1.2 Typical details and schedules in these Construction Documents shall be used wherever applicable.
- 1.3 The subcontractors shall verify all dimensions in the field, and upon discovery of any discrepancies shall be immediately reported to Drafter/Engineer. DO NOT SCALE DRAWING.
- 1.4 No changes are to be made to the plan without the consent of the drafter, engineer and building department.
- 1.5 Subcontractors shall verify all 'fit' conditions in the field. Should the subcontractor or fabricator note any conflicts or errors in the plans and/or specifications, they shall be brought to the immediate attention of Drafter/Engineer. If any questions arise during construction pertaining to any structural matter, Drafter/Engineer shall be consulted immediately for prompt resolution.
- 1.6 The subcontractor is responsible for all erection and/or temporary bracing and shoring. Where the floor is used to brace the walls, do not backfill retaining walls until main floor plywood is in place.
- 1.7 Fire-Blocking is required at all penetrations at the walls and plates including: Plumbing, Electrical and Mechanical penetrations. Fire-Block at minimum 10 feet o.c. horizontally in wall cavities.
- 1.8 Where required, use a minimum of 2500 psi concrete per 2015 IRC Table R402.2, including foundation walls, porch and garage slabs, steps and all other areas that are exposed to the weather. Maximum strength is at 28 days. Allow adequate time for foundation to set before backfilling.
- 1.9 Water Heater is to be installed per manufacturer specifications, 2015 IRC requirements and the state adopted plumbing code. Tank must be strapped at the upper and lower third of the tank. At the lower strap, strap is to be 4" minimum above the controls, per 2015 IRC Chapter 13 Section M1307.2. When installed in a garage, all appliances must have the source of ignition a minimum of 18" above the floor slab. Mechanical/Plumbing equipment is to be protected from impact of a vehicle.
- 1.10 Use 5/8" sheetrock or 1/2" sag-resistant at the ceiling per 2015 IRC section R702.3.5 and table.
- 1.11 Flashing is required at all exterior trim extrusions, window sills, jambs and other areas that water may intrude. Per the 2015 IRC, install windows per manufacturer instructions.

## 2. Foundations Notes

- 2.1 All footings shall bear on stiff, firm soil meeting the requirements of default site class "D" per 2015 IBC Section 1613.5.2. Design is based on 1500 psf soil. Contractor must verify with building department that these conditions are met prior to work.
- 2.2 All wood in contact with concrete shall be 2x Hem-Fir #2 minimum treated with an approved preservative and galvanized hot-dipped connectors (or) standard Hem-Fir on an impervious moisture barrier (IRC R319.1) or borate treated Hem-Fir #2 minimum.
- 2.3 Provide appropriate block-outs in footings or walls for plumbing and electrical stub outs.
- 2.4 Use 2500 psi concrete where required by the 2015 IRC table 402.2. Maximum compressive strength at 28 days.
- 2.5 Foundation vents are to be installed at 1 Square Foot ventilation per 150 square feet of Crawl Space per 2015 IRC Section R408.2. Vents are to be a maximum of 36" from building corners. \*\*WA State Amendments allow for 1 square foot Per 300 square feet of Crawl Space.\*\*
- 2.6 2x pressure-treated mudsill to be installed flush with the inside face of foundation wall at joist bearing points to accept joist hangers. verify that the mudsill is square at all corners. Attach the mudsill to the foundation with 1/2" x 10" anchor bolts and 1/4" x 3" x 3" washer @ 6' oc UNO.
- 2.7 Rebar is not required in interior footings unless it is below a load bearing point, or an interior shearwall per 2015 IRC Section R403.1.3.
- 2.8 The foundation in this plan is designed prescriptively, but the connections from the foundation to the mudsill is engineered for resisting lateral loads as outlined in the design criteria on the cover sheet.
- 2.9 See engineered foundation details for footing sizes.
- 2.10 Where required per 2015 IRC R406.1, foundation walls shall be damp proofed around the entire perimeter using a method that is approved by the building department.
- 2.11 Footing drains, with washed drain rock extending to within one foot of top of finished grade, shall be provided at the base of all footings and retaining walls which will have earth placed against them. Footing drains shall be 4" perforated pipe routed down gradient to daylight, unless otherwise specified. The invert elevation of all footing drains shall be lower than the bottom of adjacent footings drained.

3. Framing Notes


- 3.1 All sawn framing lumber shall be Hem-Fir #2 or better, unless otherwise shown. Provide studs directly underneath all top plate splice locations. Connect all wood members per the IBC.
- 3.2 Anchor bolts to mud sill, use 1/2" diameter x 7" embedment at 48" OC, with standard steel plate washers, wrench tight, unless otherwise shown.
- 3.3 Wood ledgers (2x8 P.T. min.) to concrete or masonry, use 5/8" diameter anchor bolts with 6-inch minimum embedment spaced 16 inches on center, staggered, unless otherwise shown.
- 3.4 Wood 2x ledgers to study or other wood, use 16d at 4 inches on center to continuous member, or 3, 16d per stud, study spaced 16" OC or less, unless otherwise shown.
- 3.5 Built-up beams consisting of dimension lumber (typically 2x stock) are permitted in lieu of sawn solid beams only if the 2x's are oriented such that they are not stacked on top of each other with the sum of their weak axes resisting load, but are nailed together side-by-side, with the sum of their strong axes resisting load. Use 16d face nails at 6" OC staggered into all tributary members.
- 3.6 Use pressure treated lumber in contact with concrete. Pressure treating chemicals shall be inert to and not reactive with metal and/or connectors.
- 3.7 Provide bridging or blocking at 8' OC max. in joist or rafters without continuous diaphragm support on the top and bottom (i.e. plywood on the top and gyp. on the bottom). Provide solid blocking at all bearing points, and double joists under all partition walls parallel to the floor joists. Framed floors which support posts shall be solidly blocked within the floor to positively transfer posts loads through the floor to the supports beneath.
- 3.8 Simpson brand is specified, however any other nationally recognized brand (Silver, KC, etc.) may be used provided that they are equivalent in their ability to carry all applied loads in all orientations.
- 3.9 The subcontractor shall install all prefabricated items in strict accordance with the manufacturer's recommendations and requirements.
- 3.10 Where holdowns are shown on the plans, the factory specified anchor bolts, lags, or nails, which connect to the vertical member shall be installed per manufacture recommendations and/or specifications. Vertical members shall be double 2x, or single 4x material unless otherwise specified. Anchor bolts, which are too long to fit in the footing in a vertical orientation, may be bent in a smooth curve to a maximum of 90 degrees and extended horizontally within the footing. 'All-thread' with head and washers at the embedded end may be substituted for long anchor bolts.
- 3.11 The Contractor shall verify with the prefab. wood manufacturer that the specified connectors will work as intended with their product.
- 3.12 Top of retaining wall (concrete, masonry, In steel) to floor joist: for wall perpendicular to joist, See Engineering.
- 3.13 For sheathing use OSB unless otherwise noted. Store and install in accordance with the recommendations of A.P.A and IBC for shear resisting vertical and horizontal diaphragms.
- 3.14 Oriented Strand Board (OSB), with shear resistance values similar to 1/2" plywood may be substituted for plywood on 5. Electrical Notes shear walls and on roof, unless otherwise specified on the Plans. If OSB is used, the same nailing and blocking schedule as per plywood shall be adhered to. Where used on roof OSB shall meet or exceed the proper span rating for trusses and/or rafters as installed. All OSB shall be stored and installed in accordance with manufacturer's recommendations.
- 3.15 All plywood on shear walls shall have all edges blocked. All blocking to receive edge nailing. If not otherwise specified on the Plans, standard shear wall construction shall consist of 1/2" plywood or 7/16" OSB, nailed with 8d at 6" on edges, and 12" in field. All shear walls shall be positively connected to horizontal diaphragms at their tops and bottoms per the above, or as called out in the Plans.
- 3.16 If roof diaphragm is not specified in Plans or Calculations, use 1/2" over non-blocked supports at 24" OC, Use IBC Case 1 pattern. Nail with 8d at 6" on edges, and 12" in field. Contractor to verify all span ratings.
- 3.17 All wood floor diaphragms shall be glued and nailed. Use thickness as shown on the Plans. Contractor to verify all span ratings of plywood. Where otherwise not shown on Plans, nail floor diaphragm using 10d (screw type nails recommended) at 6" on edges, 12" in field, non-blocked, per IBC Case 1 pattern.
- 3.18 Fire-Blocking is required at all penetrations at the walls and plates including: Plumbing, Electrical and Mechanical penetrations. Fire-Block at minimum 10 feet o.c. horizontally in wall cavities.
- 3.19 Nail all top plates together with 10d nails @ 12" o.c. and at splices with 10d nails @ 6" o.c UNO. Lap splices a minimum of 48" typical. Nail all bottom plates to floor sheathing and mudsill with (2-10d nails each stud bay. Nail all OSB sheathing with 8d nails @ 6" o.c. on edge and 12" o.c. in the field UNO. Exterior studs must be spaced at 16" o.c.
- 3.20 Cabinet, plumbing fixture and door rough openings are critical dimensions. Take care to verify that these dimensions are framed accurately.
- 3.21 See Engineering for all shearwall placements and requirements. Shearwall details must be followed exactly. Notify the designer of any discrepancies or concerns.
- 3.22 Review approved plans and details prior to starting framing work. Check for specific requirements on nailing, blocking, sheathing and anchor attachments.

4. Roofing Notes

- 4.1 Joists and rafters are to be DF #2 minimum. Rafters may be supported by posting down to flat blocking that spans a minimum of two trusses.
- 4.2 Trusses shall carry manufacturer stamp and have engineering drawings on site for inspection. All truss bracing requirements must be installed per truss drawings. DO NOT field modify any truss without prior approval from the engineer and building department. If a truss is damaged, DO NOT INSTALL IT. Contact the builder immediately for a replacement truss.
- 4.3 Framing connections shall be "Simpson Strong Tie" or an approved equivalent.
- 4.4 Provide attic ventilation per 2015 IRC R806.2. The net free ventilated area shall be 1/300 square feet. 50% of the required ventilation area shall be a minimum of 3 feet above eave vents. The balance of required ventilation shall be provided at the eaves.
- Provide a minimum rough opening 22x30 attic access panel with a tight fitting, self closing door. Door shall be backed with insulation if located above heated space. Verify access location with owner and plans.
- 4.6 UNO. Sheath Roof per 2015 IBC Case 1 (Staggered Panels Unblocked). Fasten panels with 8d nails @ 6" oc @ edge and 12" oc in the field. DO NOT STAPLE! Unless Approved by a Licence Engineer.
- 4.7 UNO. Toe-Nail all gable end trusses with (2) 10d nails @ 16" oc into top plates.
- 4.8 UNO. Toe-Nail each end of truss at bearing walls with (2) 10d nails and fasten with truss clips per

- 5.1 Smoke detectors shall be 110v. Hard wired with battery backup and shall be interconnected. Owner shall be responsible for smoke detectors if a monitored fire system is required.
- 5.2 Electrical contractor shall coordinate location of panel and meter with contractor.
- 5.3 Electrical contractor shall provide heat-loss calculations or follow the prescriptive path requirements for sizing heating equipment.
- 5.4 Electrical contractor shall conform to all local and state codes.
- 5.5 Exact placement of outlets may vary depending on construction variables.
- 5.6 Where a dryer is vented through a foundation vent the vent must be completely sealed to prevent moist exhaust are from reentering the crawl space.
- 5.7 Per 2015 IRC R315.1 An approved carbon monoxide alarm shall be installed outside of each separate sleeping area in the immediate vicinity of the bedroom in dwelling units and on each level of the dwelling and in accordance with the manufacturers recommendations.

oment & Permitting Service ISSUED PERMIT Engineering Public Works Gabe Spruell Ph: 253.312.5523 E.



Farris, Rich & Kathy
2345 West Stewart
Puyallup, WA 98371
253-255-3413
Parcel # - 0420207029

General **Notes** 

PHS Job #: 19.056 Printed On: 7/26/2023 18:36:50

Layout Sheet # 12 of 12