
A 10" diameter core drill is allowed for potholing. For pothole windows larger than 10" in diameter or trenching completed in existing roadway, the contractor shall restore the pavement by installing the trench patch and then grinding/overlaying. All roadway restoration and street patches shall comply with City Standard Detail 01.01.20.

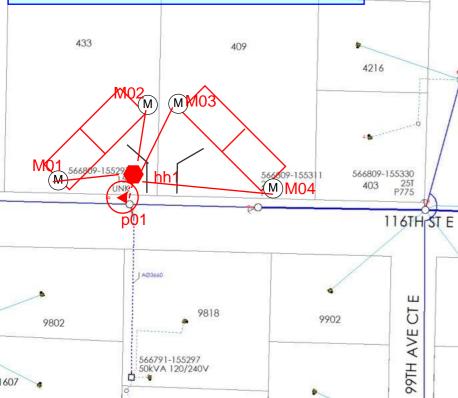

JOB NUMBER: 105103711 / 104356950-433 A&B 104356951-409 A&B

ADDRESS: 409 & 433 43RD AVE SW PUYALLUP

PERMIT: Y EASEMENT: Y FLAGGERS: Y OUTAGES: Y LOCATES: CUSTOMER LRC: 65 SQ FT: 1864 EACH PANEL: 200A EACH VDROP: 0.6% FLICKER: 2.1%

## DESCRIPTION:

THS

P01: GRID #\_\_566809-155297\_\_\_\_3-11 HANG 25 KVA, 120/240V OH XFMR OR INST L/B C/O ON C/O BRACKET, FUSE @ \_\_T OR INST L/B C/O ON PRIMARY ARM, FUSE @ \_\_T INST STIRRUP TAP \_\_ PHASE INST POLE GND (AS REQ'D) INST \_\_" SEC RISER ON EXIST S/O BRACKETS, (ACTUAL=\_\_\_') INST GRID# \_\_\_\_\_

P01-H01 3-22 INST 350 UG TPLX, ± \_60\_\_' IN PSE PROVIDED 3" CONDUIT, (ACTUAL=\_\_\_') H01

## PRFUP20231497

INST 17"x 30" SEC HH W/#10-350 (6) POS CONN BARS

H01-M01 Handhole H01 shall be located on private property. CONNECT & TAG CUST INSTALLED UG SVC CONDUCTORS (\_1\_\_RUNS OF \_4/0 )

H01-M02 CONNECT & TAG CUST INSTALLED UG SVC CONDUCTORS (\_1\_\_RUNS OF \_4/0 )

H01-M03 CONNECT & TAG CUST INSTALLED UG SVC CONDUCTORS (\_1\_\_RUNS OF \_\_4/0 )

## H01-M04

City of Puyallup

ISSUED PERMIT

Planning

Public Works

Traffic

Building

Engineering

CONNECT & TAG CUST INSTALLED UG SVC CONDUCTORS (\_1\_RUNS OF \_\_4/0 )

All proposed franchise utilities shall be located within a recorded utility easement or in the public right-of-way as determined by the City of Puyallup. The City of Puyallup does not authorize or permit utility work on private property. PSE shall provide as-builts to the property owner and project manager for utility crossing conflicts, particularly with water and stormwater, during future site development.