


(NORTH PORTION)
RIVER FRONT INDUSTRIAL PARK

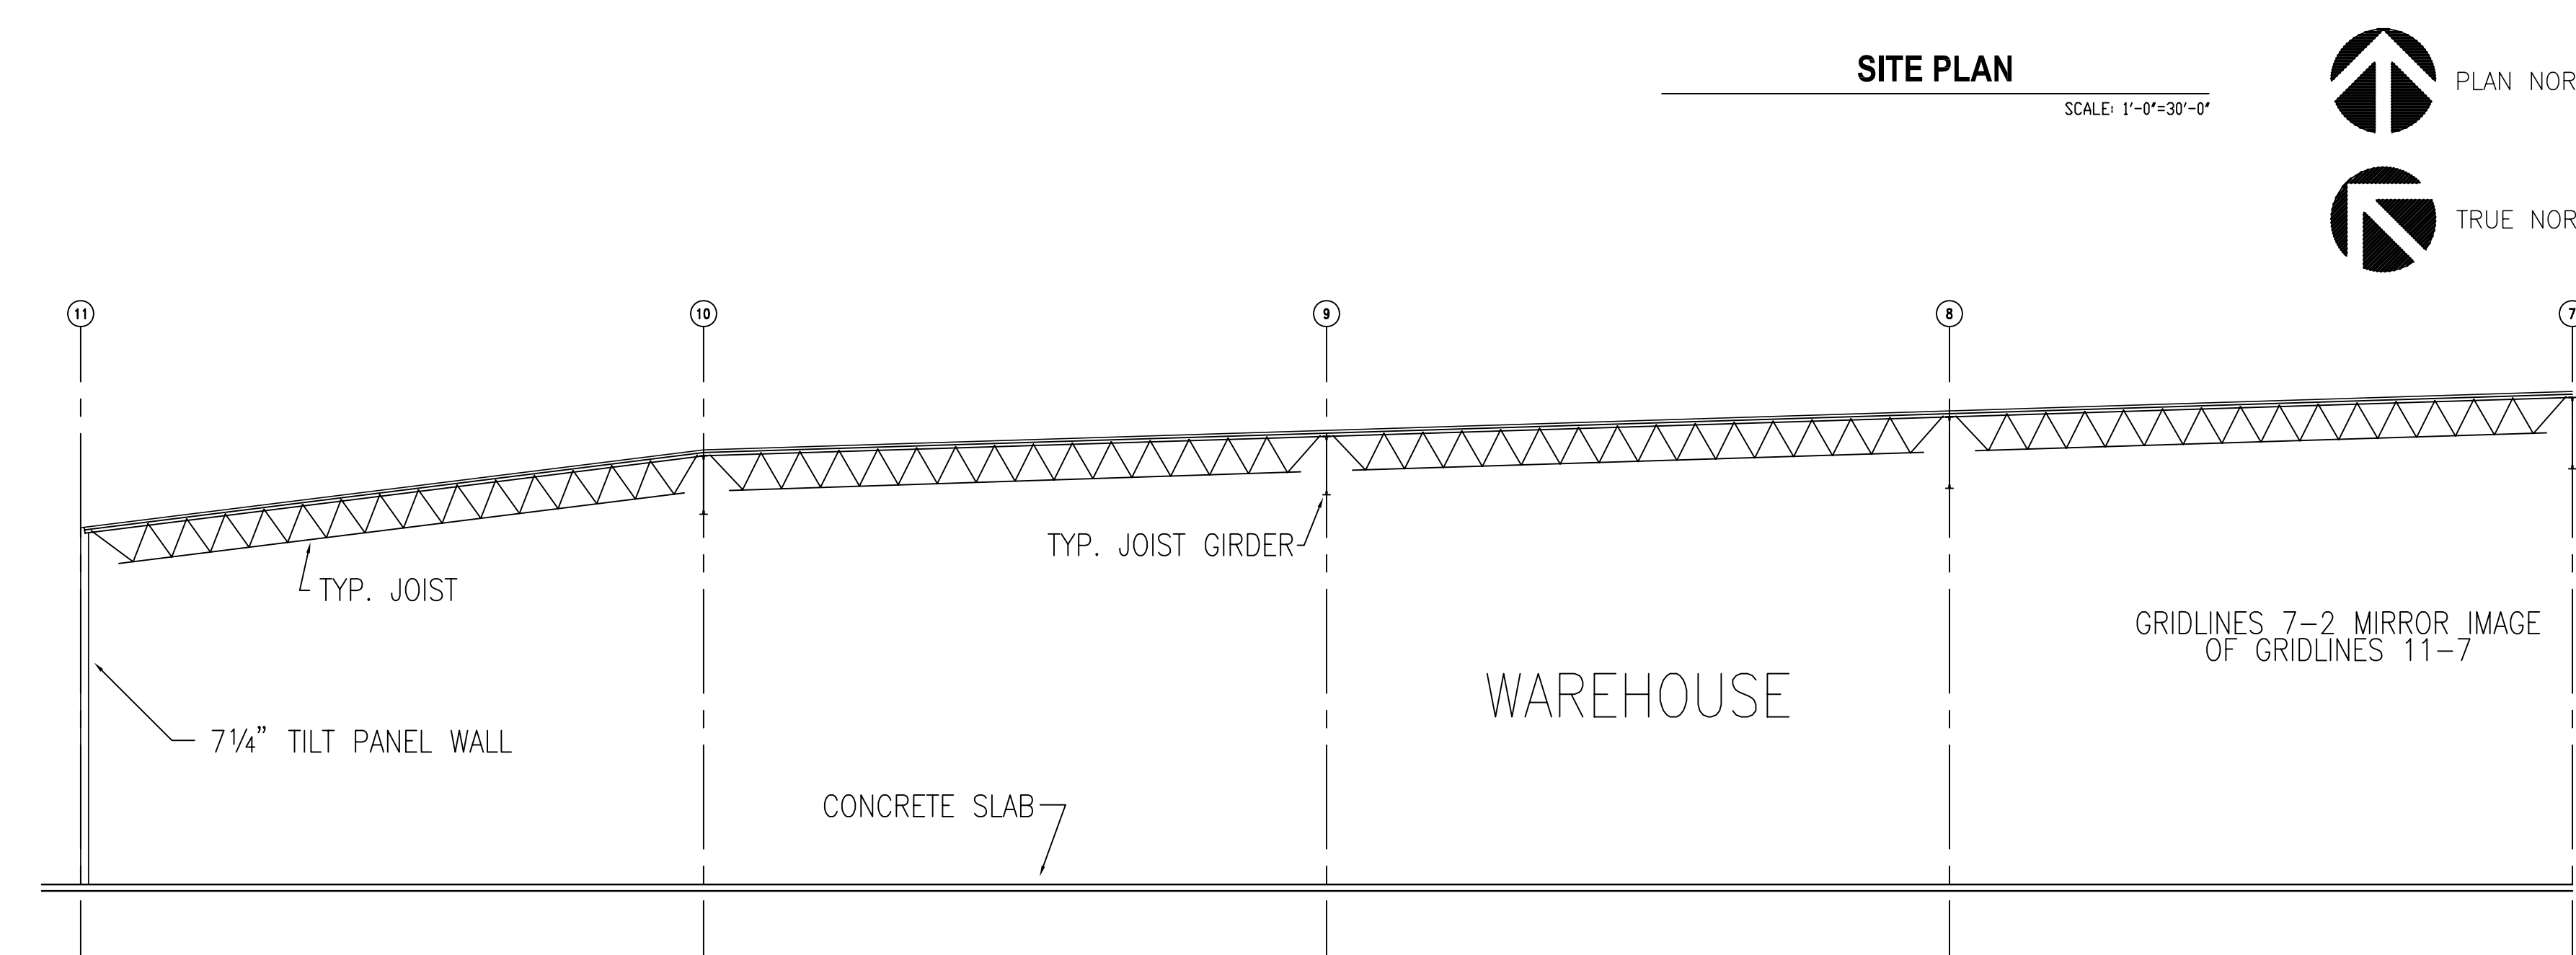

FP1	PARTIAL SITE PLAN – NORTH
FP2	PARTIAL SITE PLAN – SOUTH
FP3	PARTIAL FLOOR PLAN – NW
FP4	PARTIAL FLOOR PLAN – NE
FP5	PARTIAL FLOOR PLAN – SW
FP6	PARTIAL FLOOR PLAN – SE
FP7	PUMP ROOM LAYOUT
FP8	RISER MANIFOLD ELEVATIONS

Approval of submitted plans is not an approval of omissions or oversight by this office or noncompliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable building codes and regulations of the local government.

Building	Planning
Engineering	Public Works
Fire	Traffic

TEMP. RATING	SPRINKLERS UP AND DOWN	OPENING	SYMBOL	OPENING
		UP		DOWN
165 °		1"		1"
212 °		1/2"		1/2"
286 °		1"		1"
350 °		1/2"		1/2"
500 °		1/2"		1/2"

APPROVAL REQUIRED
BY OF PUYALLUP

[illegible]

QUALITY CONTROL BY	MM	DATE	9.6.06
APPROVED FOR FABRICATION BY		DATE	

GENERAL NOTES

1. ALL MATERIAL AND EQUIPMENT TO BE NEW AND US LISTED OR TR APPROVED.
2. PIPING DOWNSTREAM ARE CENTER TO CENTER EXCEPT RISERS AND DIMENSIONS SHOWN THICKLY (-) MUST BE CENTER TO CENTER.
3. EXISTING MANHOLE SHALL BE RECONSTRUCTED IN ACCORDANCE WITH WETFA PARAGRAPH 13. APPLICABLE EDITION.
4. PIPE HANGERS AND METHOD OF HANGING TO BE IN ACCORDANCE WITH WETFA PARAGRAPH 13. APPLICABLE EDITION.
5. PIPING SHALL BE IN ACCORDANCE WITH WETFA PARAGRAPH 13. APPLICABLE EDITION.
6. JOINTING OF PIPE AND FITTINGS, THROUGH A WELDED, SHALL BE IN ACCORDANCE WITH WETFA PARAGRAPH 13. APPLICABLE EDITION.
7. OWNER TO PROVIDE ADEQUATE HEAD IN AREAS PROVIDED BY A WET PIPE SPRINKLER SYSTEM TO REQUEST HAD WET IN PIPES FROM FREEZING.
8. ALL WIRING OF ELECTRICAL SYSTEMS (IF REQUIRED) TO BE PROVIDED BY OTHERS.
9. PAINTING OF PIPE & EQUIPMENT (IF REQUIRED) TO BE PROVIDED BY OTHERS.
10. TURNING OF PIPE & EQUIPMENT (IF REQUIRED) TO BE PROVIDED BY OTHERS.

DESIGN CRITERIA 1. K=17.0 ESRF WITH 52 PSI END HEAD PRESSURE FOR 35' STORAGE IN A 40' BUILDING.	
PIPE NOTES 1. THREADED PIPE TO BE BLACK SCHEDULE 40. 2. GROOVED & WELDED BRANCHLINE PIPE TO BE SPS FLOW AND MAIN PIPE TO BE BLACK SCHEDULE 10.	


[illegible]

CONTRACT WITH:
FOUSHEE AND ASSOCIATES, INC
3260 118TH AVENUE SE SUITE 300
BELLEVUE, WA 98009
Robert Guymer 425.466.2388

PROJECT NAME:
RIVER FRONT INDUSTRIAL
BLDG. B PARTIAL SITE PLAN - NORTH
1301 N LEEVEE ROAD
PUYALLUP, WA 98371



DESIGNER	JIMMY TWINING	SHEET	FP 1
DATE	9.14.06	1 OF 8	
JOB NO.	11-1540		

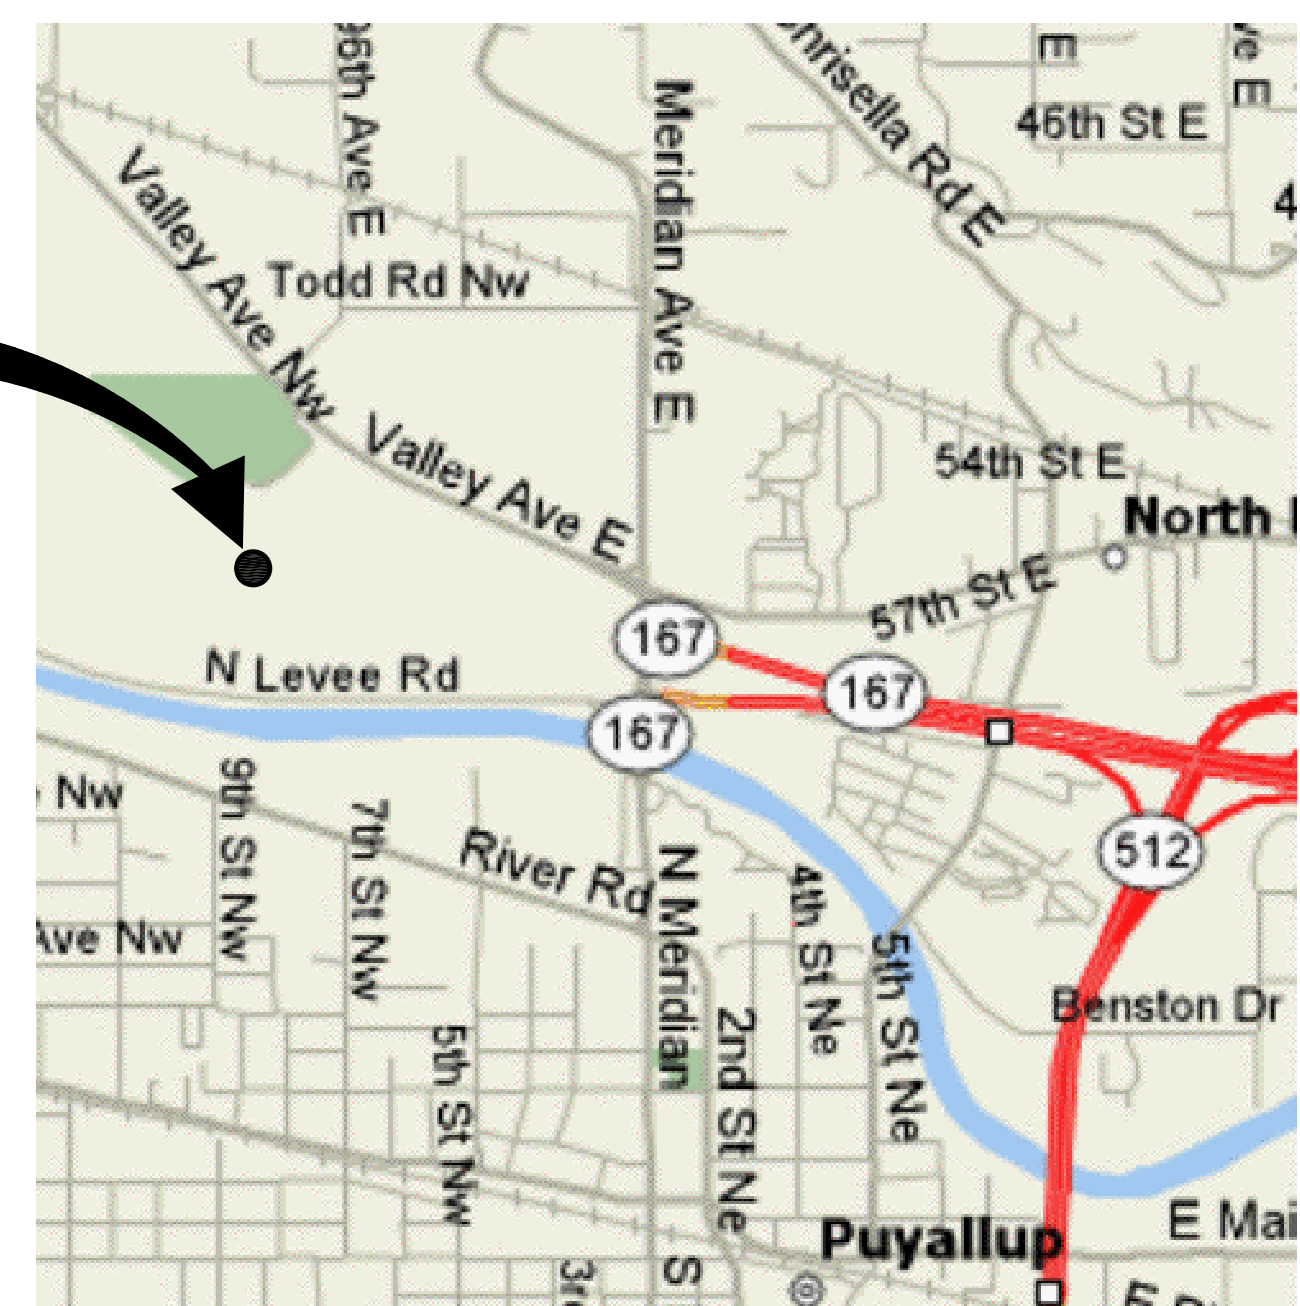

SITE

STATIC	60 PSI
RESIDUAL	20 PSI
FLOW	4590 GPM
SOURCE	GRAY&OSBORNE
LOCATION	@ SITE
DATE	3.6.06
ELEVATION	32.00

1. THIS SITE PLAN IS FOR REFERENCE ONLY. SEE ARCHITECTURAL AND CIVIL DRAWINGS FOR ADDITIONAL SITE PLAN INFORMATION.
2. UNDERGROUND PIPING BY OTHERS.
3. ALL UNDERGROUND PIPE TO BE INSTALLED RODDED AND/OR BLOCKED, FLUSHED AND TESTED PER NFPA 13 & 24.
4. MINIMUM BURY 4'-0".
5. PATRIOT START POINT AT FLANGES INSIDE BUILDING.