


Foreman Please Fill In:  
 Install  Remove  
 Grid # 566916-156170  
 Trf Size 5 KVA  
 Tested Sec Voltage \_\_\_\_\_  
 Mfg Moloney  
 Serial # 1420655  
 Co. ID # \_\_\_\_\_  
 Oil Cap in Gal. 4  
 Impedance 2.4  
 Mfg < ppm PCB? \_\_\_\_\_  
 Bushings 2

~~Foreman Please Fill In:  
 Install  Remove  
 Grid # 566916-156170  
 Trf Size \_\_\_\_\_  
 Tested Sec Voltage \_\_\_\_\_  
 Mfg \_\_\_\_\_  
 Serial # \_\_\_\_\_  
 Co. ID # \_\_\_\_\_  
 Oil Cap in Gal. \_\_\_\_\_  
 Impedance \_\_\_\_\_  
 Mfg < ppm PCB? \_\_\_\_\_  
 Bushings \_\_\_\_\_~~

INSTALL PER POLE TABLE  
 INSTALL DDE 3 PHASE (6034.1044) DDEU315  
 REPLACE TRANSFORMER WITH 15KVA PER (6025.1000) TRFLXF  
 COMMUNICATIONS, INTOLIGHT TAG SLAR0938, STREETLITE, & SECONDARY TO TRANSFER  
 INSTALL GRID & STRUCTURE NUMBERS

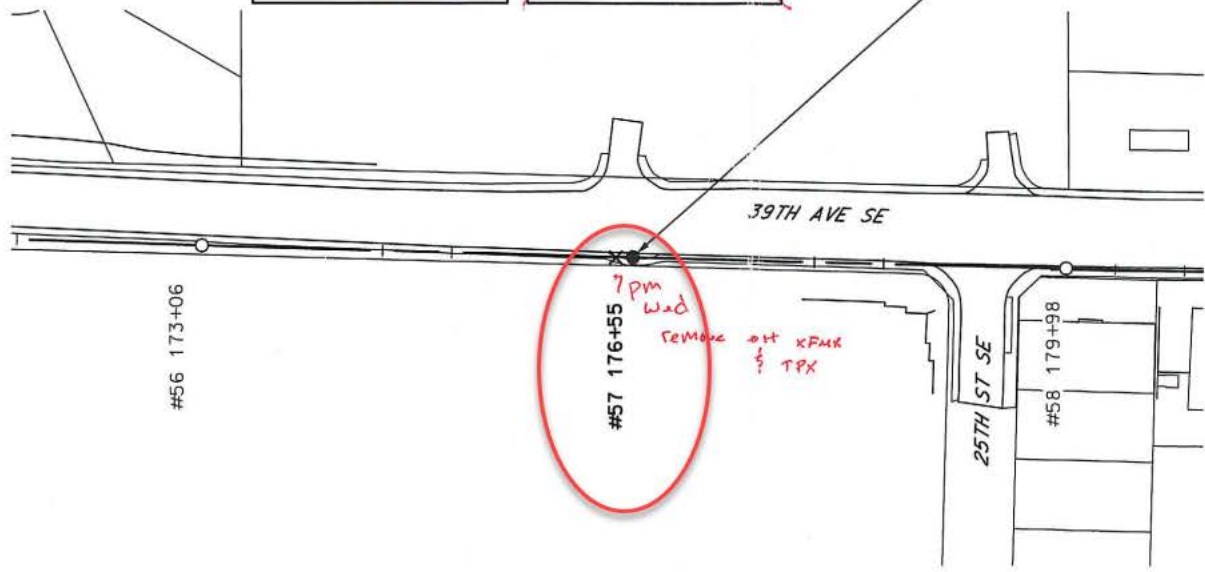

PLAN SCALE  
 1" = 100'

