


**SCOPE OF WORK**  
 ADD & RELOCATE HD'S FOR NEW T.I. CLG'S

**DESIGN CRITERIA**  
 NFPA 13, 2016 EDITION - VET CLINIC - LIGHT HAZ. 225 S.F./HD MAX.  
 MAX. OF 2 HD'S FROM 1" OUTLETS

- GENERAL NOTES**
1. ALL MATERIAL AND INSTALLATION PER NFPA 13
  2. ALL ARM-OVERS EXCEEDING 24" TO BE HUNG PER NFPA 13 - 12' IF SYSTEM PRESSURE EXCEEDS 100 PSI
  3. ALL NEW PIPE IS SCH. 40 BLACK STEEL W/D 1.5 SCREWED FTG'S
  4. TESTING PER NFPA 13 & LOCAL AUTHORITY HAVING JURISDICTION
  5. T.I. MOD'S DO NOT AFFECT SYSTEM CALC'S

- LEGEND**
- EXIST. PIPE
  - NEW PIPE
  - HANGER LOCATION
  - CLG HEIGHT
  - EXIST. SPRINKLER - PEND. & CLG.
  - NEW LOCATION OF EXIST. PEND. HD.
  - NEW FIRELOCK FLGR SEMI-RECESS CHROME 1/2" 155° K=5.6
  - REMOVE EXIST. DROP & HEAD & INSTALL 1" PLUG
  - FLEX DROP
  - CAN LIGHT
  - TRACK LIGHT
- QTY = 63  
 QTY = 10  
 QTY = 13  
**TOTAL 86**

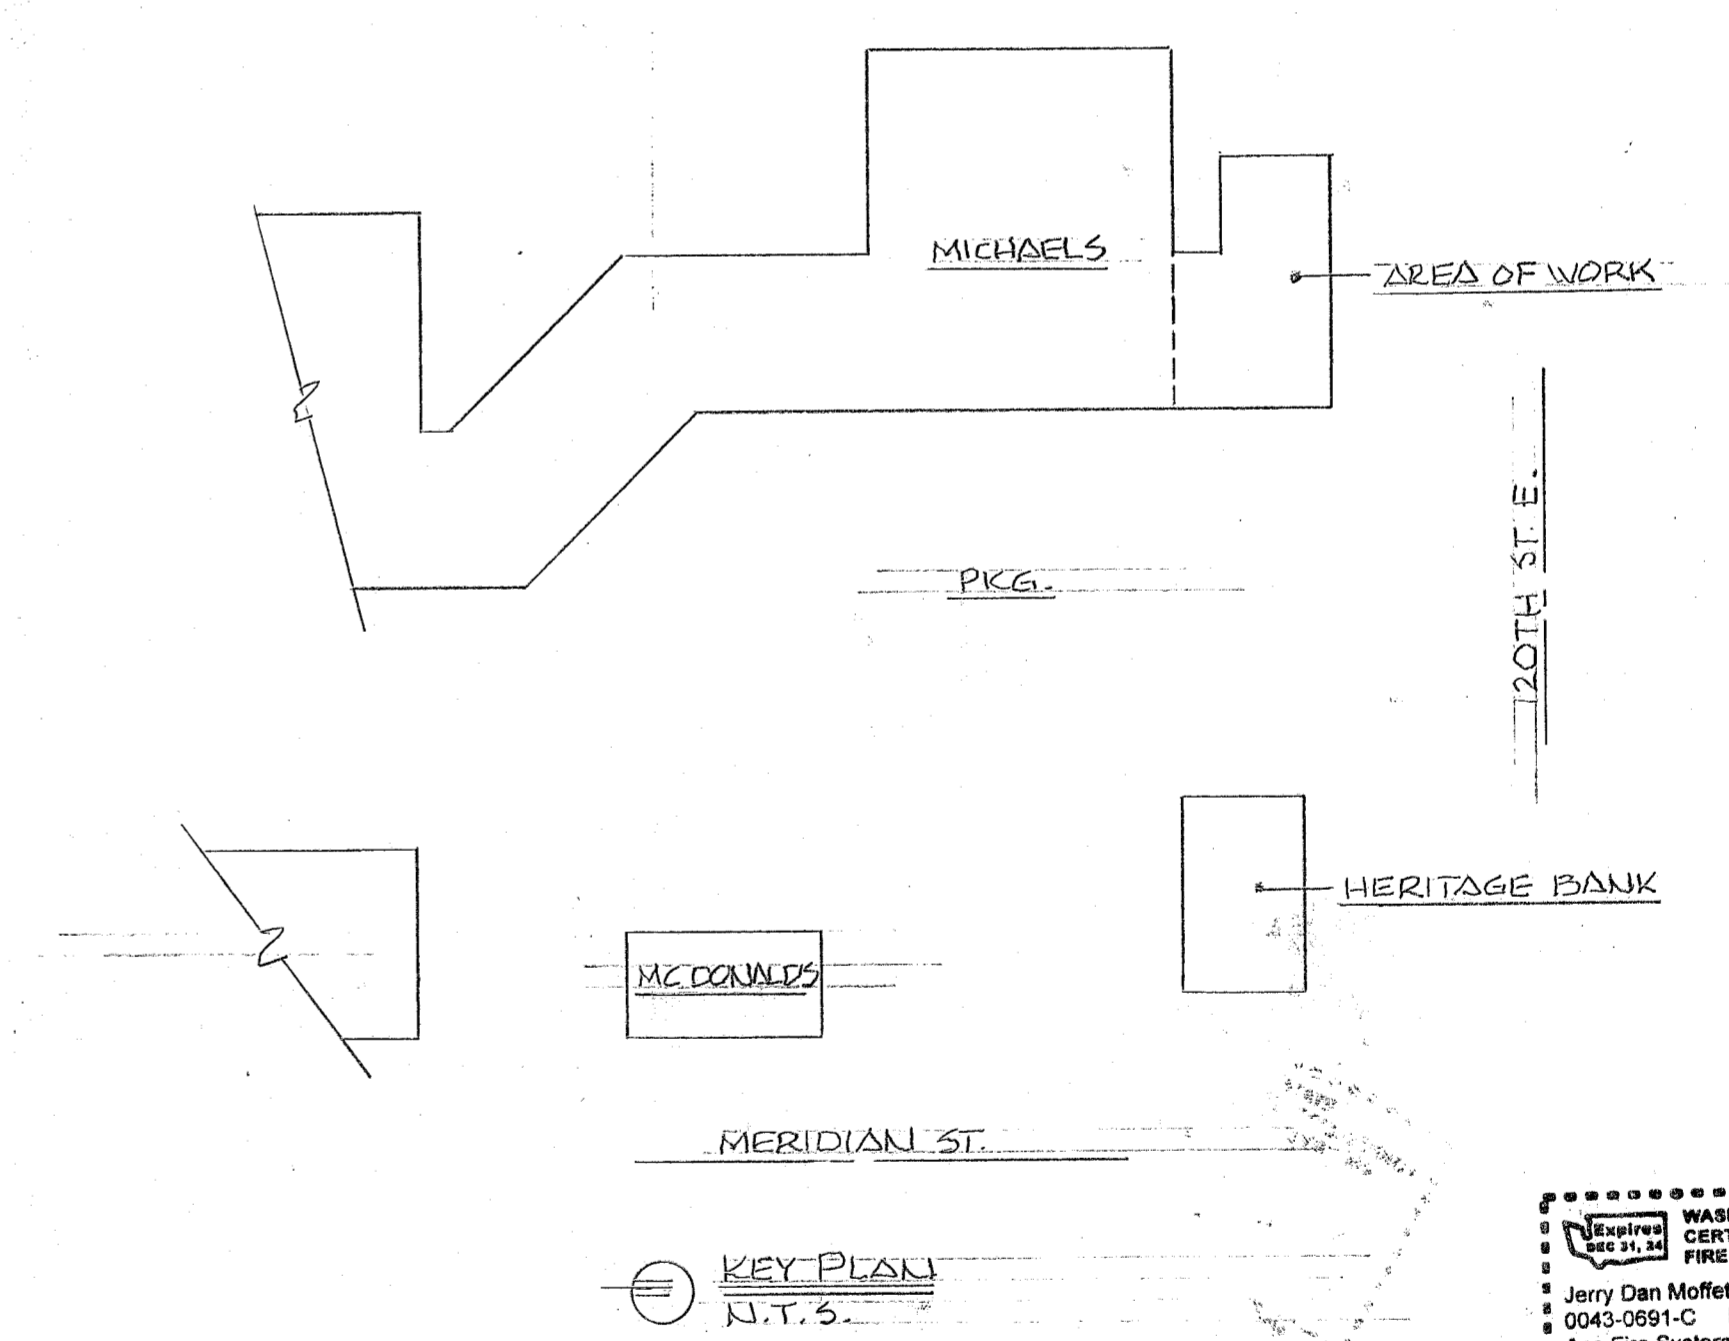

REF. CLG. PLAN  
 1/8" = 1'-0"

Read Permit Conditions prior to calling for inspection.

**City of Puyallup  
 Fire  
 REVIEWED  
 FOR  
 COMPLIANCE**

DDrake  
 02/12/2024  
 1:08:31 PM

THE APPROVED CONSTRUCTION PLANS AND ALL ENGINEERING MUST BE POSTED ON THE JOB AT ALL INSPECTIONS IN A VISIBLE AND READILY ACCESSIBLE LOCATION.

Approval of submitted plans is not an approval of omissions or oversight by this office or noncompliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable building codes and regulations of the local government.

|  |              |
|--|--------------|
| City of Puyallup<br>Development & Permitting Services<br>ISSUED PERMIT |              |
| Building   | Planning     |
| Engineering  | Public Works |
| Fire   | Traffic      |

WASHINGTON STATE  
 CERTIFICATE OF COMPETENCY  
 FIRE SPRINKLER SYSTEMS

Jerry Dan Moffett  
 0043-0891-C Level 3  
 Ace Fire System, LLC  
 ACEFSS0891M3  
 2/5/24  
 Signature Date

**ACE  
 FIRE SYSTEMS LLC**

P.O. BOX 2065 CENTER REG # ACEFIS908M3  
 BUCKLEY, WA 98321-2065  
 BUS: (206) 414-1573 CELL: (206) 349-1175 FAX: (360) 829-4301

VALUE PET CLINIC  
 12314 MERIDIAN E.  
 PUYALLUP, WA 98373.

BLDG. PERMIT #  
 PARCEL # 0419102125

DATE: 1/12/24  
 DRAWN BY: J.D.M.

REVISED 2/5/24  
 SCALE AS NOTED