

City of Puyallup Development & Permitting Services ISSUED PERMIT	
Building	Planning
Engineering	Public Works
Fire	Traffic



February 05, 2024

STRUCTURAL CALCULATIONS
(Permit Submittal)


**CENTERIS DATA CENTER VOLTAGE PARK
FOUNDATIONS**

1023 39th Avenue SE
Puyallup, WA 98374

Quantum Job Number: 23444.01

Prepared for:
CENTERIS DATA CENTERS
18300 Cascade Avenue S
Seattle, WA 981188

Prepared by:
QUANTUM CONSULTING ENGINEERS
1511 Third Avenue, Suite 323
Seattle, WA 98101
TEL 206.957.3900
FAX 206.957.3901

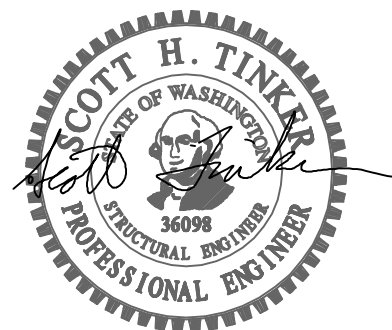

⚠ This is a beta release of the new ATC Hazards by Location website. Please [contact us](#) with feedback.

ℹ The ATC Hazards by Location website will not be updated to support ASCE 7-22. [Find out why.](#)

ATC Hazards by Location

Search Information


Address: 1015 39th Ave SE Puyallup, WA 98374

Coordinates: 47.1590004, -122.2794422

Elevation: 489 ft

Timestamp: 2023-12-01T15:13:57.333Z

Hazard Type: Wind

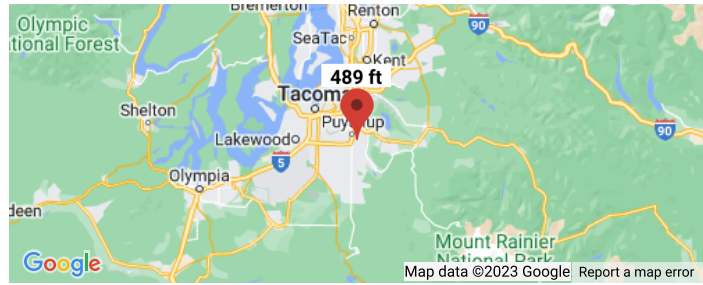

ASCE 7-16

MRI 10-Year 67 mph

MRI 25-Year 73 mph

MRI 50-Year 78 mph

MRI 100-Year 82 mph

Risk Category I 92 mph

Risk Category II 97 mph

Risk Category III 104 mph

Risk Category IV 108 mph

ASCE 7-10

MRI 10-Year 72 mph

MRI 25-Year 79 mph

MRI 50-Year 85 mph

MRI 100-Year 91 mph

Risk Category I 100 mph

Risk Category II 110 mph

Risk Category III-IV 115 mph

ASCE 7-05

ASCE 7-05 Wind Speed 85 mph

The results indicated here DO NOT reflect any state or local amendments to the values or any delineation lines made during the building code adoption process. Users should confirm any output obtained from this tool with the local Authority Having Jurisdiction before proceeding with design.

Please note that the ATC Hazards by Location website will not be updated to support ASCE 7-22. [Find out why.](#)

Disclaimer

Hazard loads are interpolated from data provided in ASCE 7 and rounded up to the nearest whole integer. Per ASCE 7, islands and coastal areas outside the last contour should use the last wind speed contour of the coastal area – in some cases, this website will extrapolate past the last wind speed contour and therefore, provide a wind speed that is slightly higher. NOTE: For queries near wind-borne debris region boundaries, the resulting determination is sensitive to rounding which may affect whether or not it is considered to be within a wind-borne debris region.

Mountainous terrain, gorges, ocean promontories, and special wind regions shall be examined for unusual wind conditions.

While the information presented on this website is believed to be correct, ATC and its sponsors and contributors assume no responsibility or liability for its accuracy. The material presented in the report should not be used or relied upon for any specific application without competent examination and verification of its accuracy, suitability and applicability by engineers or other licensed professionals. ATC does not intend that the use of this information replace the sound judgment of such competent professionals, having experience and knowledge in the field of practice, nor to substitute for the standard of care required of such professionals in interpreting and applying the results of the report provided by this website. Users of the information from this website assume all liability arising from such use. Use of the output of this website does not imply approval by the governing building code bodies responsible for building code approval and interpretation for the building site described by latitude/longitude location in the report.

⚠ This is a beta release of the new ATC Hazards by Location website. Please [contact us](#) with feedback.

ℹ The ATC Hazards by Location website will not be updated to support ASCE 7-22. [Find out why.](#)

ATC Hazards by Location

Search Information

Address: 1015 39th Ave SE Puyallup, WA 98374
Coordinates: 47.1590004, -122.2794422
Elevation: 489 ft
Timestamp: 2023-12-01T15:14:56.409Z
Hazard Type: Seismic
Reference Document: ASCE7-16
Risk Category: III
Site Class: D-default



Basic Parameters

Name	Value	Description
S _S	1.257	MCE _R ground motion (period=0.2s)
S ₁	0.433	MCE _R ground motion (period=1.0s)
S _{MS}	1.508	Site-modified spectral acceleration value
S _{M1}	* null	Site-modified spectral acceleration value
S _{DS}	1.005	Numeric seismic design value at 0.2s SA
S _{D1}	* null	Numeric seismic design value at 1.0s SA

* See Section 11.4.8

Additional Information

Name	Value	Description
SDC	* null	Seismic design category
F _a	1.2	Site amplification factor at 0.2s
F _v	* null	Site amplification factor at 1.0s
CR _S	0.914	Coefficient of risk (0.2s)
CR ₁	0.898	Coefficient of risk (1.0s)
PGA	0.5	MCE _G peak ground acceleration
F _{PGA}	1.2	Site amplification factor at PGA
PGA _M	0.6	Site modified peak ground acceleration
T _L	6	Long-period transition period (s)
SsRT	1.257	Probabilistic risk-targeted ground motion (0.2s)
SsUH	1.375	Factored uniform-hazard spectral acceleration (2% probability of exceedance in 50 years)
SsD	1.5	Factored deterministic acceleration value (0.2s)
S1RT	0.433	Probabilistic risk-targeted ground motion (1.0s)
S1UH	0.483	Factored uniform-hazard spectral acceleration (2% probability of exceedance in 50 years)
S1D	0.6	Factored deterministic acceleration value (1.0s)
PGA _d	0.5	Factored deterministic acceleration value (PGA)

* See Section 11.4.8

The results indicated here DO NOT reflect any state or local amendments to the values or any delineation lines made during the building code adoption process. Users should confirm any output obtained from this tool with the local Authority Having Jurisdiction before proceeding with design.

8	7	6	5	4	3	2	1																																				
<p>PROJECT NAME: CAT 3516C-HD 2,500KW W/ ALUMINUM UL2200 SOUND ATTENUATED ENCLOSURE</p>																																											
<p>GENERAL NOTES:</p>																																											
<p>1) DIMENSIONS AND WEIGHTS PROVIDED IN THESE DOCUMENTS ARE ESTIMATES BASED ON CALCULATION.</p>																																											
<p>PROJECT NOTES:</p>																																											
<p>1) GENSET: CATERPILLAR 3516C-HD, 2,500KW WEIGHT: 42,000 LBS. DIMENSIONS: 280.16"L X 90.12"W X 117.53"H ENGINE DWG # 593-3169</p> <p>2) ENCLOSURE WALLS: 0.08" ALUMINUM PANELS</p> <p>3) ENCLOSURE FRAME: 2"x2"x0.125" AL TUBING</p> <p>4) ENCLOSURE COLOR: TRAFFIC GREY.</p> <p>5) ESTIMATED TOTAL PACKAGE WEIGHT: 86,500 LBS DRY</p> <p>6) INTERIOR LINING: PERFORATED GALVANIZED STEEL</p> <p>7) SOUND ATTENUATION LEVEL: LEVEL 2, 85dBA AT 23FT (AVG FREE FIELD)</p> <p>8) SOUND ATTENUATION MATERIAL: 2" ROCKWOOL.</p> <p>9) SUBBASE FRAME SHALL BE PROVIDED W/ 8 LIFTING POINTS.</p> <p>10) ENCLOSURE UL 2200 LISTED, 130MPH WIND LOAD. DESIGN AIR FLOW: INTO ENCLOSURE: 102,586 CFM, 0.0710 LBS./FT3 OUT OF ENCLOSURE: 110,698 CFM, 0.06F1 LBS./FT3 MAX AMBIENT SPEC: 123°F@2460FT ASL.</p> <p>11) TANK INFORMATION: TANK UL 142 LISTED, NFPA-30 COMPLIANT. USABLE GALLONS: 8,400 NOMINAL GALLONS: 8,614 ESTIMATED TANK WEIGHT (DRY): 18,750 LBS</p>																																											
<p>DRAWING SET OUTLINE</p>																																											
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width:5%;">SHEET 1</td> <td>COVER SHEET</td> </tr> <tr> <td>SHEET 2</td> <td>BILL OF MATERIALS</td> </tr> <tr> <td>SHEET 3</td> <td>ELEVATION VIEWS</td> </tr> <tr> <td>SHEET 4</td> <td>ELEVATION VIEWS</td> </tr> <tr> <td>SHEET 5</td> <td>SECTION VIEWS</td> </tr> <tr> <td>SHEET 6</td> <td>ELECTRICAL DETAILS</td> </tr> <tr> <td>SHEET 7</td> <td>CONTROL AND WIRING DETAILS</td> </tr> <tr> <td>SHEET 8</td> <td>DIODE LAYOUT DETAILS</td> </tr> <tr> <td>SHEET 9</td> <td>TANK DETAILS</td> </tr> <tr> <td>SHEET 10</td> <td>NFPA 30 PANEL DETAILS</td> </tr> <tr> <td>SHEET 11</td> <td>CONCRETE PAD DETAILS</td> </tr> </table>								SHEET 1	COVER SHEET	SHEET 2	BILL OF MATERIALS	SHEET 3	ELEVATION VIEWS	SHEET 4	ELEVATION VIEWS	SHEET 5	SECTION VIEWS	SHEET 6	ELECTRICAL DETAILS	SHEET 7	CONTROL AND WIRING DETAILS	SHEET 8	DIODE LAYOUT DETAILS	SHEET 9	TANK DETAILS	SHEET 10	NFPA 30 PANEL DETAILS	SHEET 11	CONCRETE PAD DETAILS														
SHEET 1	COVER SHEET																																										
SHEET 2	BILL OF MATERIALS																																										
SHEET 3	ELEVATION VIEWS																																										
SHEET 4	ELEVATION VIEWS																																										
SHEET 5	SECTION VIEWS																																										
SHEET 6	ELECTRICAL DETAILS																																										
SHEET 7	CONTROL AND WIRING DETAILS																																										
SHEET 8	DIODE LAYOUT DETAILS																																										
SHEET 9	TANK DETAILS																																										
SHEET 10	NFPA 30 PANEL DETAILS																																										
SHEET 11	CONCRETE PAD DETAILS																																										
<p>DRAWING FOR APPROVAL NOT FOR CONSTRUCTION PURPOSES</p> <p>APPROVED AS DRAWN <input type="checkbox"/> APPROVED AS NOTED <input type="checkbox"/> REVISE AS NOTED, RESUBMIT <input type="checkbox"/></p> <p>SIGNATURE _____ DATE _____</p> <p>NAME (PLEASE PRINT) _____ TITLE _____</p>																																											
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width:15%;">CUSTOMER</td> <td colspan="3"></td> </tr> <tr> <td>REFERENCES: ALUM. 0.08" SKIN ON ALUM. 24x60.125 TUBING</td> <td style="width:15%;">UNITED STATES: 10</td> <td style="width:15%;">DO NOT SCALE</td> <td style="width:15%;">REVISION</td> </tr> <tr> <td></td> <td></td> <td></td> <td style="text-align: center;">C</td> </tr> <tr> <td></td> <td></td> <td></td> <td style="text-align: center;">DATE: 6/24/2022</td> </tr> <tr> <td colspan="4" style="text-align: center;"> GENERAL ARRANGEMENT SUBMITTAL COVER SHEET </td> </tr> <tr> <td>DRW. DWG</td> <td>JOB SERIAL NO.</td> <td colspan="2"></td> </tr> <tr> <td>CHK. JPR</td> <td>22-0804, 22-0805, 22-0806,</td> <td colspan="2"></td> </tr> <tr> <td>APP. KYB</td> <td>22-0952</td> <td colspan="2"></td> </tr> <tr> <td>SCALE</td> <td>NTS</td> <td>SHEET</td> <td>1 OF 11</td> </tr> </table>								CUSTOMER				REFERENCES: ALUM. 0.08" SKIN ON ALUM. 24x60.125 TUBING	UNITED STATES: 10	DO NOT SCALE	REVISION				C				DATE: 6/24/2022	GENERAL ARRANGEMENT SUBMITTAL COVER SHEET				DRW. DWG	JOB SERIAL NO.			CHK. JPR	22-0804, 22-0805, 22-0806,			APP. KYB	22-0952			SCALE	NTS	SHEET	1 OF 11
CUSTOMER																																											
REFERENCES: ALUM. 0.08" SKIN ON ALUM. 24x60.125 TUBING	UNITED STATES: 10	DO NOT SCALE	REVISION																																								
			C																																								
			DATE: 6/24/2022																																								
GENERAL ARRANGEMENT SUBMITTAL COVER SHEET																																											
DRW. DWG	JOB SERIAL NO.																																										
CHK. JPR	22-0804, 22-0805, 22-0806,																																										
APP. KYB	22-0952																																										
SCALE	NTS	SHEET	1 OF 11																																								

ITEM	QTY.	ITEM DESCRIPTION	SHT #	SUPPLIER	MFG. DWG. #	REVISIONS	DATE	AP'D
1	2	3	4	5	6	7	8	9
1	1	CUSTOMER PROVIDED CATERPILLAR 3516C-HD (2.500KW) GENSET.	3.4.9	--	593-3169	DESCRIPTION	5/19/2022	DMG
2	1	ENCLOSURE: 2'x2'x0.125" ALUM. TUBING COVERED IN 0.08" ALUMINUM PANELS. SLOPED ROOF. WIND RATING 130 MPH.	3.4			ORIGINAL SUBMITTAL	5/19/2022	DMG
3	4	WALK-IN DESIGN: 2" ROCKWOOL LEVEL 2, 85CBA AT 2.3FT (AVG FREE FELD).	3.4			CUSTOMER COMMENTS	5/25/2022	JPR
4	40	SINGLE ACCESS MAINTENANCE DOORS FITTED WITH WATERTIGHT RUBBER SEALS, DRIP LEDGES AND ALL FITTED WITH HEAVY DUTY REFRIGERATOR STYLE CHROME PLATED HANDLES, KEYS-A-LIKE & PAD LOCKABLE. HEAVY DUTY ALUMINUM PIANO HINGES FITTED WITH PANIC RELEASE, DOOR-HOLD-BACK LATCH AND BULB SEAL.	3.4			480V PANEL BOARD	6/2/2022	DMG
5	24	X-336 SINGLE ACCESS MAINTENANCE DOORS FITTED WITH WATERTIGHT RUBBER SEALS, DRIP LEDGES AND ALL FITTED WITH HEAVY DUTY REFRIGERATOR STYLE CHROME PLATED HANDLES, KEYS-A-LIKE & PAD LOCKABLE. HEAVY DUTY ALUMINUM PIANO HINGES FITTED WITH PANIC RELEASE, DOOR-HOLD-BACK LATCH AND BULB SEAL.	3.4					
6	1	REAR PLENUM WITH BIRDSCREENING FOR VERTICAL AIR INTAKE. FITTED WITH MOTORIZED INTAKE LOUVERS (QTY 6).	3					
7	1	FRONT PLENUM WITH BIRDSCREENING FOR VERTICAL RADIATOR AIR DISCHARGE. FITTED W/ GRAVITY DISCHARGE LOUVERS (QTY 6).	3					
8	1	EXHAUST SILENCER: Ø80x27, CRITICAL GRADE, INTERNALLY INSULATED, DISC-TYPE.	3.4					
9	1	EXHAUST 90° ELBOW WITH WELDED RAINGUARD (SHIP LOOSE).	3.4					
10	2	FLEXIBLE CONNECTOR TO ENGINE.	3.4					
11	1	RAINCAP (SHIP LOOSE).	3.4					
12	1	8,400 GALLON SUBBASE TANK, NFPA-30 COMPLIANT.	3.4.8					
13	1	UL-142 LISTED STEEL DESIGN DIESEL FUEL TANK WITH HEAVY DUTY SIDE CHANNELS, PAINTED WITH TWO COATS OF BLACK FINISH, DOUBLE WALL W/ 10% RUPTURE BASIN FOR SECONDARY CONTAINMENT.						
14	1	VENT/FILL/ALARM PACKAGE INCLUDING: UL/NFPA SIZED EMERGENCY VENTS & 2" NORMAL VENT.						
15	1	MULTIPLE FUEL ALARM SWITCHES, MANUAL LOCKING FILL CAP, VISUAL FUEL LEVEL GAUGE AND LEAK DETECTION SWITCH. INSTALL AND WIRE FUEL TANK LEVEL SWITCHES, CRITICAL HIGH-LOW FUEL LEVEL ALARMS AND LEAK DETECTION ALARM TO ENGINE TERMINAL STRIP. YES TO PROVIDE AND INSTALL BRAIDED STAINLESS STEEL FUEL SUPPLY AND RETURN LINES TO AND FROM ENGINE. SITE PIPING BY OTHERS.						
16	1	MORRISON 918S PANEL.	3.5,9,10					
17	1	CAT BATTERY SET (8) AND CABLES. YES TO SUPPLY BATTERY RACK.	3		LF-5478			
18	8	PROVIDE AND INSTALL BATTERY HEATER PADS.	3.7					
19	20	BATTERY CHARGER	3		2860177			
20	1	WIRE AND INSTALL DIODE(S) FOR CUSTOMER PROVIDED BATTERY SELECTOR.	3.7		BBS-800			
21	1	150A, 120/208V, 3Ø, BASIC CIRCUIT BREAKER TYPE LOAD CENTER.	3.6		S305483150			
22	1	CUSTOMER PROVIDED 4000A, TRISTAR DOCKING STATION.	3.6		LF-9803			
23	1	45KVA DRY TRANSFORMER, 480V PRIMARY, 120/208V SECONDARY, 3Ø, MOUNTED ON THE WALL.	3.6		HT45A3B2-D16			
24	1	100AMP, 480V, 3Ø, BASIC CIRCUIT BREAKER TYPE POWER PANEL.	3.7		P1E1BMC250AT			
25	4	120VAC, 48" LED LIGHT FIXTURES.	3.6		VT300S450P			
26	2	24VDC VAPOR PROOF LIGHT FIXTURES.	3.6		VX100DG			
27	1	60 MINUTE TIMER FOR DC LIGHTS.	3.6		FDB0MHW			
28	3	3-WAY SWITCHES, WALL MOUNTED, W/WEATHERPROOF COVER.	3.6		2097			
29	2	DUPLEX GFCI RECEPTACLE.	3.6		CS20AC3W			
30	1	4.5KW SPACE HEATER, THERMOSTATICALLY CONTROLLED.	3.6		LPW204ST			
31	2	DAYTON 484X38 EXHAUST FAN INSTALLED IN DISCHARGE WALL.	3.4,6		494X38			
32	1	THERMOSTAT FOR EXHAUST FAN.	3.6		8426			
33	1	E-STOP, BREAK GLASS, NEMA-3R (SHIP LOOSE).	3.6		ST120SN3RBP2			
34	1	ALL WIRING TO AND FROM ELECTRICAL ACCESSORIES IS TO BE INSTALLED IN ELECTRICAL METALLIC TUBING (EMT) AND LIQUID TIGHT FLEXIBLE CONDUIT. SHORE POWER TO BE PROVIDED BY CUSTOMER.	N/S					
35	1	7.5 GALLON SPILL BUCKET W/ 4" NPT FILL PORT.	3.9		518CC-0100 AC			
36	1	OVERFILL PREVENTION VALVE SET AT 95%, DROP TUBE TO BE 6" FROM BOTTOM OF TANK.	3.9		9095X-2200AV			
37	1	CHECK VALVE ON FUEL SUPPLY.	3.9		7746K822			
38	1	PROVIDE AND INSTALL TRIPLEX RACOR FILTER WITH SHUT OFF VALVES.	3.9		79100FN30			
39	1	INSTALL CUSTOMER PROVIDED FUEL POLISHING SYSTEM WIRED TO EMCP FOR STATUS.	3.6,9		CFS1500-CP50-BH			
40	1	INSTALL CUSTOMER PROVIDED FUEL FLOW METER.	3.9					
41	1	PROVIDE AND INSTALL BRAIDED STAINLESS STEEL FUEL LINES.	3					
42	1	INSTALL CUSTOMER PROVIDED 5 GALLON KENCO OIL TANK.	3.9		CCV12000			
43	1	SUPPLY AND INSTALL CLOSED CRANKCASE VENTILATION CANISTER.	3					
44	1	WATER DRAIN BULKHEAD FITTINGS (3/4" MALE JIC).	3.9		2700-12-12			
45	1	VIBRATION ISOLATORS.	3.4,9		579-3582			
46	2	ALUMINUM PERSONAL TRAVEL RESTRAINT SYSTEM TIE-OFF.	3.4					
47	1	SMALL DOCUMENT HOLDER.	3					
48	1	INSTALL REMOVABLE ACCESS PANEL FOR DOCKING STATION ELECTRICAL ACCESS.	3		9000-07			
49	1	PROVIDE RADIATOR COOLANT, AND FILL RADIATOR PRIOR TO SHIPPING.	N/S					
50	1	INSTALL CUSTOMER PROVIDED SURGE PROTECTOR.	3					
51	1	BREAK APART PACKAGE FOR SHIPPING (TANK ENCLOSURE & GENSET). DO NOT INSTALL AT&AC PIPE FOR SHIPPING.	N/S					
52	1	REMOVABLE COVER/TOP PLATE FOR STUB-UP AREA.						

SHIP LOOSE ITEMS TO BE
INSTALLED AT SITE BY OTHERS

DRAWING FOR APPROVAL
NOT FOR CONSTRUCTION PURPOSES


APPROVED AS DRAWN
APPROVED AS NOTED
REVISE AS NOTED, RESUBMIT

SIGNATURE _____ DATE _____
NAME (PLEASE PRINT) _____ TITLE _____

CUSTOMER: **REFERENCES: ALUM. 0.08" SKIN ON ALUM. 26x6x1.58 TUBING**
UNITED STATES: 16 DO NOT SCALE
REVISION

DATE: 6/2/2022

GENERAL ARRANGEMENT SUBMITTAL
E.O.M.
JOB SERIAL NO. 22-0804, 22-0805, 22-0806,
JOB # 22-0952
SCALE: NTS
SHEET 2 OF 11

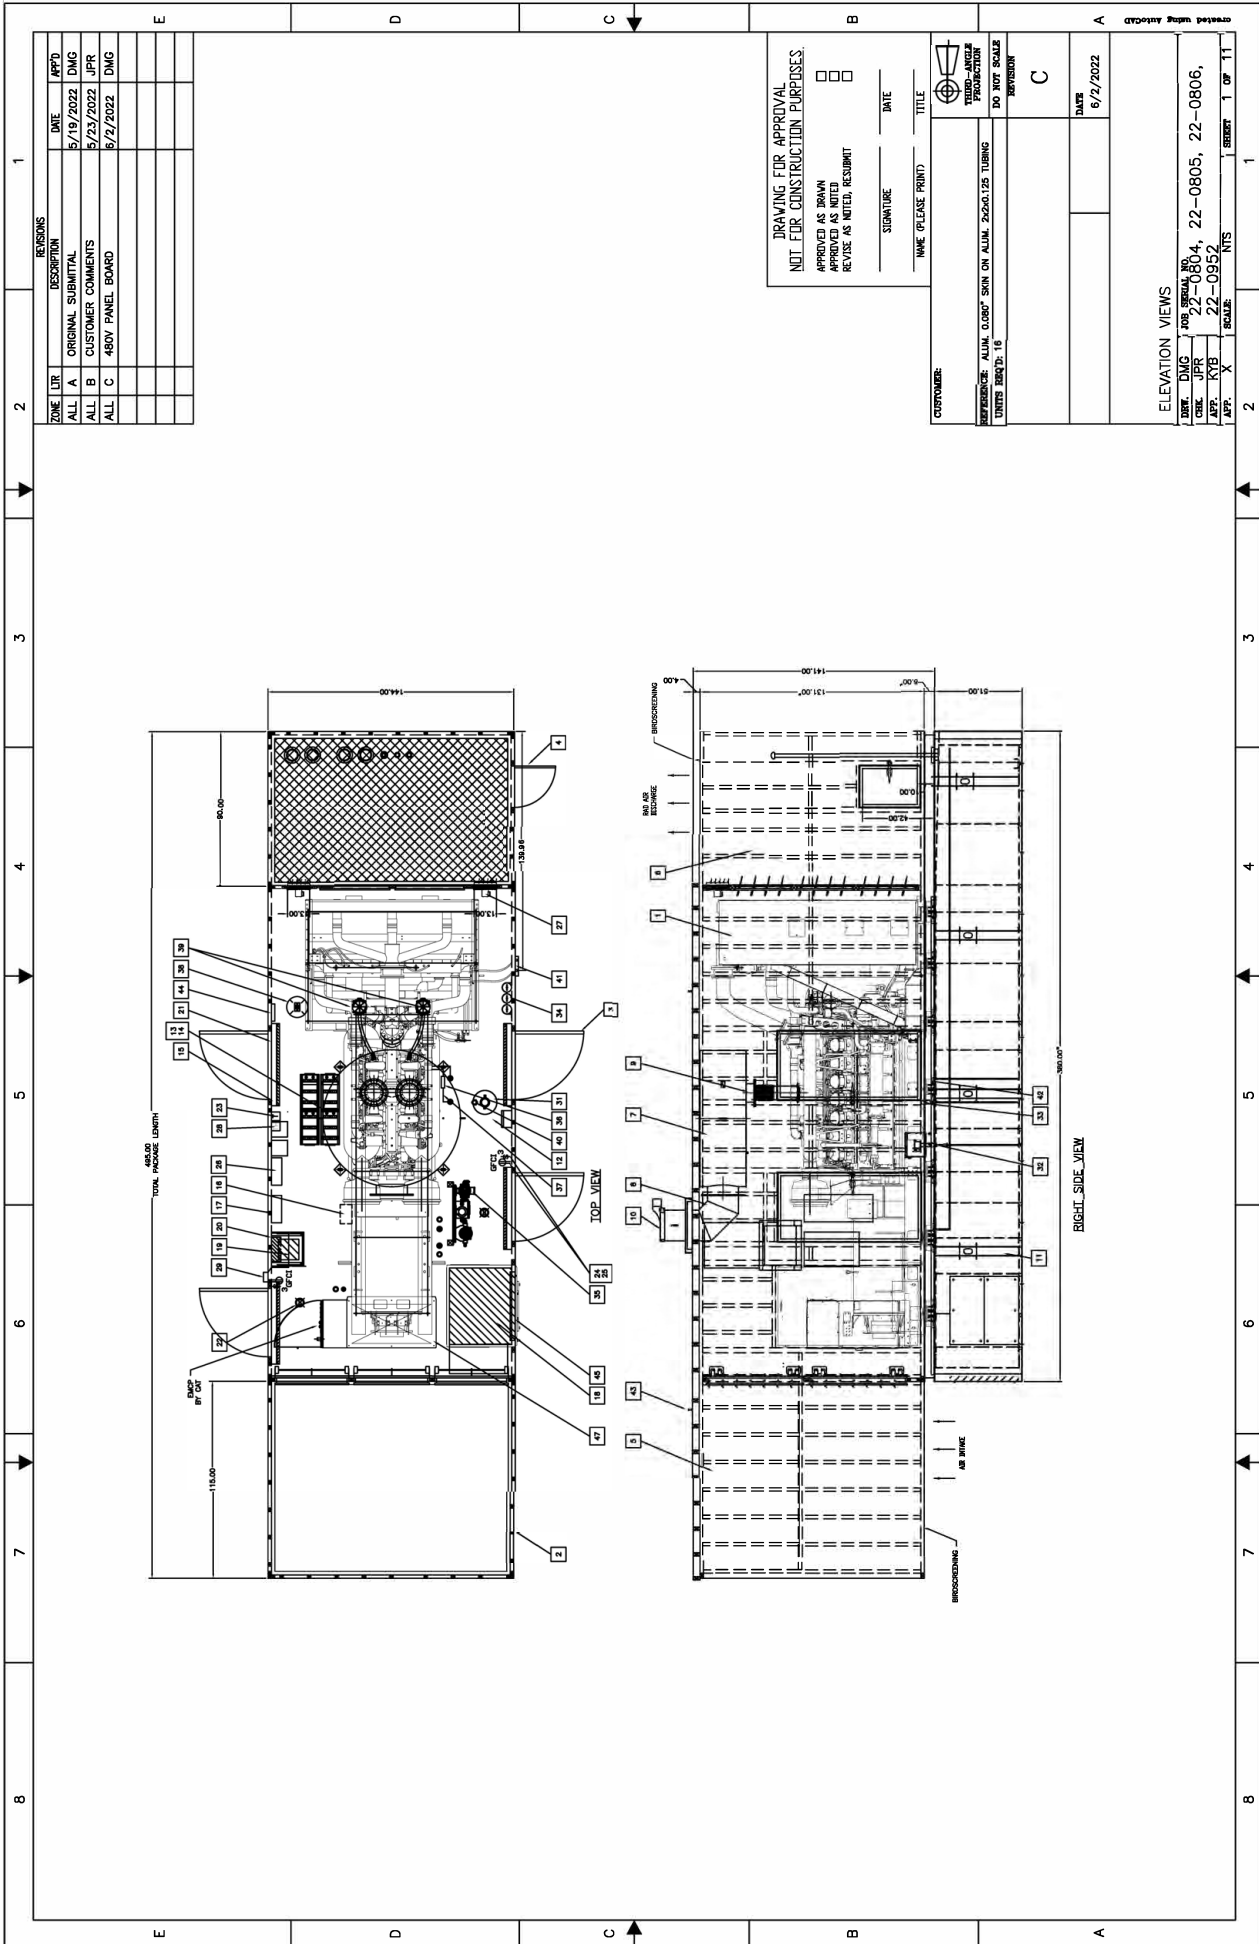

ZONE	LR	REVISIONS	DATE	APP'D
ALL	A	ORIGINAL SUBMITTAL	5/19/2022	DMG
ALL	B	CUSTOMER COMMENTS	5/23/2022	JPR
ALL	C	480V PANEL BOARD	6/2/2022	DMG

DRAWING FOR APPROVAL
 NOT FOR CONSTRUCTION PURPOSES
 APPROVED AS SHOWN
 APPROVED AS NOTED
 REVISE AS NOTED, RESUBMIT


SIGNATURE _____ DATE _____
 TITLE _____

NAME (PLEASE PRINT) _____
 TITLE _____

CUSTOMER:	REFERENCE: ALUM. 0.060" SKIN ON ALUM. 25X30.125 TUBING
	UNIT SIZE: 10
	TO BUY SCALE
	REVISION
	C
	DATE: 6/2/2022

ELEVATION VIEWS

DRW.	DMG	DES. SERIAL NO.	22-0804, 22-0805, 22-0806,
CHK.	JPR	APP. NO.	22-0952
APP.	X	SCALE	NTS
		SHEET	1 OF 11

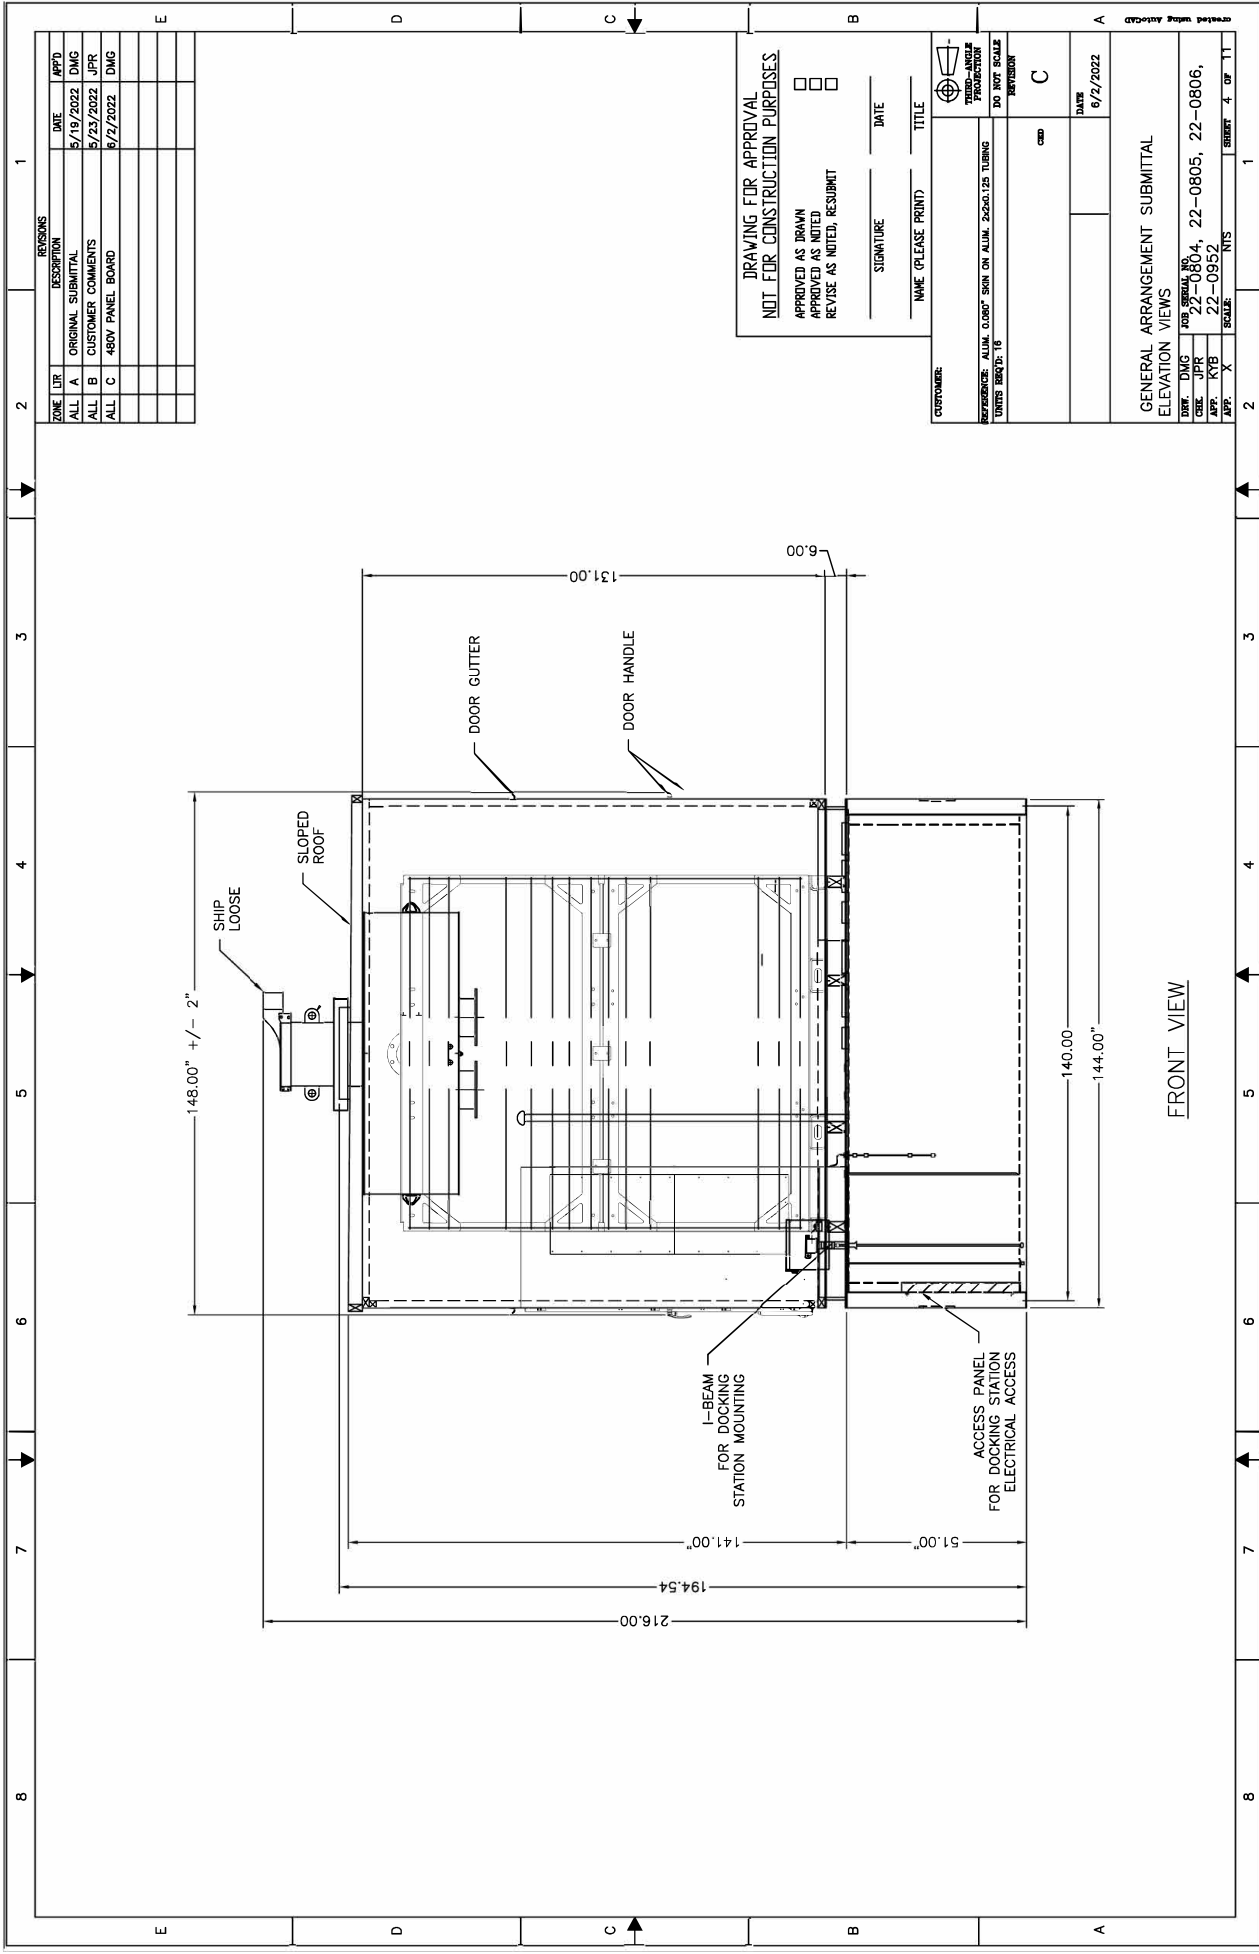

ZONE	LR	DESCRIPTION	DATE	APP'D
ALL	A	ORIGINAL SUBMITTAL	5/19/2022	DMG
ALL	B	CUSTOMER COMMENTS	5/23/2022	JPR
ALL	C	480V PANEL BOARD	6/2/2022	DMG

**DRAWING FOR APPROVAL
NOT FOR CONSTRUCTION PURPOSES**

APPROVED AS DRAWN
 APPROVED AS NOTED
 REVISE AS NOTED, RESUBMIT

SIGNATURE _____ DATE _____
 TITLE _____

CUSTOMER: _____

REFERENCE: ALUM. 0.060" SKIN ON ALUM. 2x2x0.125 TUBING
 UNITS: IMPER: 16

DATE: 6/2/2022

SCALE: C

GENERAL ARRANGEMENT SUBMITTAL
 ELEVATION VIEWS

DRW: DMG JOB SERIAL NO: 22-0804, 22-0805, 22-0806,
 CBE: JPR 22-0952
 APP: KYB
 SCALE: X

DATE: 6/2/2022

1 2 3 4 5 6 7 8

FRONT VIEW

Ground Supported Tank For Liquids Seismic Design

IBC 2018, ASCE 7-16 Chapter 15

Seismic Criteria:

Site Class:	D	R:	3	ASCE Table 15.4-2 Flat Bottom Ground Supported Steel Tanks Mechanically Anchored
S_s :	1.26	L:	10	Tank Length
S_1 :	0.43	h:	3.145	Top of Liquid, ft
S_{D5} :	1.01	Tc:	2.0155	ASCE EQ 15.7-12
S_{D1} :	0.54	T_L :	6	ASCE Figure 22-14
I_E :	1.25			

$$T_s = S_{D1} / S_{D5} = 0.53$$

$$T_i < T_s \quad \text{Conservative}$$

$$\therefore S_{ai} = S_{ds} = 1.01 \quad \text{ASCE EQ 15.7-7}$$

$$T_c < T_L$$

$$\therefore S_{ac} = 1.5 S_{D1} / T_c = 0.402 \quad \text{ASCE EQ 15.7-10}$$

$$V_i = S_{ai} I_E / (R) = 0.42 W_i \quad \text{ASCE EQ 15.7-5}$$

$$V_c = S_{ac} I_E / (1.5) = 0.33 W_c \quad \text{ASCE EQ 15.7-6}$$



Quantum Consulting Engineers LLC

1511 Third Avenue, Suite 323

Seattle, WA 98101

Project: **Centeris Data Centers**

Date: **12/15/23** Job No: **23444.01**

Designer: **TVM** Sheet: **1**

Client: **Benaroya**

Checked:

2500 KW CAT Generator Foundation Design

IBC 2018, ASCE 7-16, ACI 318-14

1.) Generator

Enclosure Weight:	25.8 kips	Total Height H:	192 in
Generator Weight:	42 kips	Total Width B:	148 in
Tank Weight:	18.8 kips	Total Width L:	495 in
Tank Capacity:	8614 gal	Tank Int. Height H_T :	51 in
Liquid S.G.:	0.88	Tank Int. Width W_T :	140 in
Liquid Weight:	63.2 kips	Tank Int. Length L_T :	380 in
Snow Load:	25 psf		

2) Seismic Design per ASCE 7-16 Chapter 15 Non-Building Structure Procedure

Lateral System

Flat Bottom Ground Supported
Steel Tanks Mechanically Anchored

R:	3.0	ASCE Table 15.4-2
Ω_0 :	2.0	ASCE Table 15.4-2
C_d :	2.5	ASCE Table 15.4-2
I_E :	1.25	

Lateral Loads

Lateral resistance is provided by the steel tank anchored to the concrete slab.
See Ground Supported Tank For Liquids Seismic Design Spreadsheet

$V_i =$	0.42 W_i	ASCE EQ 15.7-5
$V_c =$	0.33 W_i	ASCE EQ 15.7-6

Enclosure EQ = $V_i * W_e =$	10.8 kips
Generator EQ = $V_i * W_g =$	17.7 kips
Tank EQ = $V_i * W_t =$	7.9 kips

Liquid $W_i =$	22.8 kips	ACI 350.3-06 EQ 9-15
Liquid $W_c =$	3.8 kips	ACI 350.3-06 EQ 9-16
Liquid EQ = $V_i * W_i + V_c * W_c =$	10.8 kips	



Quantum Consulting Engineers LLC
1511 Third Avenue, Suite 323
Seattle, WA 98101

Project: Centeris Data Centers

Date: 12/15/23 Job No: 23444.01

Designer: TVM Sheet: 1

Client: Benaroya

Checked:

2500 KW CAT Generator Foundation Design

IBC 2018, ASCE 7-16, ACI 318-14

2) Seismic Design per ASCE 7-16 Chapter 15 Non-Building Structure Procedure

Shear Connection

$V = \Sigma EQ =$ 47.2 kips Assume 3/4" Hilti KB3 SS
 Number of Anchors = 22.0 with 3 1/4" embed.
 Anchor Shear = $0.7 * V * \Omega / \# =$ 3.01 kips/anchor < ASD Capacity = 5.7 kips OK

Overturing Resistance About Width

	C.O.G.	EQ	OT Moment
Enclosure	121.5 in	10.8 kips	110 k-ft
Generator	88.8 in	17.7 kips	131 k-ft
Tank	25.5 in	7.9 kips	16.8 k-ft
Liquid	25.5 in	10.8 kips	23 k-ft
		$M_{OT} =$	280 k-ft
	Moment Arm	DL	Res. Moment
Resisting Dead Load	74 in	86.5 kips	533 k-ft
Resisting Liquid	74 in	63.2 kips	390 k-ft
		$M_R =$	923 k-ft
F.O.S. = $M_R / M_{OT} =$	3.3 OK Full Tank		
F.O.S. = $M_R / M_{OT} =$	2.1 OK Empty Tank		

3) Wind Design per ASCE 7-16 Chapter 29 Non-Building Structure Procedure

Wind Speed V: 104.0 mph ASCE 7-16 Risk Category III
 Exposure Cat. B
 Exposure Coe Kz: 0.62 Table 26.10-1 (H = 20')
 Direction Coe. Kd: 0.85 Table 26.6-1
 Topo Coe. Kzt: 1.00 Sec. 26.8

 V_Pressure qz = 14.6 psf EQ 26.10-1
 Gust Factor G: 0.85 Sec 26.11
 Af = 660 sqft
 h/d = 1.30
 Cf = 1.31 Figure 29.4-1
 F = 10.72 kips EQ 29.4-1

Shear Connection

WL < EQ Shear Connection OK By Inspection

Overturing Resistance About Width

$M_{OT} = F * H / 2$ 86 k-ft
 $M_R = DL * W / 2$ 533 k-ft (Exclude Liquid Weight)
 F.O.S. = $M_R / M_{OT} =$ 6.2 OK



Quantum Consulting Engineers LLC
 1511 Third Avenue, Suite 323
 Seattle, WA 98101

Project: Centeris Data Centers

Date: 12/15/23 Job No: 23444.01

Designer: TVM Sheet: 2

Client: Benaroya

Checked:

2500 KW CAT Generator Foundation Design

IBC 2018, ASCE 7-16, ACI 318-14

4) Foundation Design

Bearing Analysis

Allowable Bearing	2000 psf
Footing Width:	40 ft
Footing Length:	14 ft
Thickened Edge Width:	1 ft

Dead Load (Full):	150 kips
Snow Load:	12.7 kips
1.0DL+1.0SL Pressure:	1504 psf < 2000 psf OK

Earthquake OT (Full)	280 k-ft
Applied Pressure:	500 psf
1.15DL+0.7EQ Pressure:	1945 psf < 2000 psf * (4/3) OK

Sliding Analysis

Slab-on-Grade Thickness	8 in
-------------------------	------

Allow. Coefficient of Friction:	0.3	
(0.7) Earthquake (Full):	33.1 kips	
Dead Load (Full):	206 kips	Includes Slab-on-Grade Weight
Sliding Resistance:	61.7 kips	
Unity Check $U_c =$	1.87 > 1.0 OK	

(0.7) Earthquake (Empty)	25.5 kips	
Dead Load (Empty):	143 kips	Includes Slab-on-Grade Weight
Sliding Resistance:	42.8 kips	
Unity Check $U_c =$	1.68 > 1.0 OK	



Quantum Consulting Engineers LLC
1511 Third Avenue, Suite 323
Seattle, WA 98101

Project: Centeris Data Centers

Date: 12/15/23 Job No: 23444.01

Designer: TVM Sheet: 3

Client: Benaroya

Checked:



TANK NOTES:

- 1. ALL FITTINGS TO BE CARBON STEEL WELD FLANGES (UNLESS OTHERWISE NOTED)
- 2. EXTERIOR FINISH: "BLACK" - TKP - STANDARD TANK/BASE PAINT, MARINE INLAND
- 3. INNER TANK DIMENSIONS: 450.50"L x 137.875"W x 37.742"H
- 4. APPROXIMATE USEABLE TANK CAPACITY: 8,300 GALLONS @ 90 %
- 5. ACTUAL TANK VOLUME (100%): 9,458 GALLONS
- 6. APPROXIMATE TANK WEIGHT: 22,000 LBS

NOTES:

- 1. GENERATOR, KOHLER KD2500 OPEN, ALT: KH08430T04D
DIMENSIONS: 264.4"L X 114.8"W X 130.0"H
WEIGHT: 53,363 LBS
- DRAWING #: ADV-8925
- 2. TOTAL AIRFLOW REQUIRED: 97345 CFM
- 3. SOUND ATTENUATION LEVEL: 15 dBA) REDUCTION AT 23 FEET
- 4. INSULATION: 2" MAT-FACED MICRO-AIRE DUCT BOARD
- 5. LINING: MILL-FINISH PERFORATED ALUMINUM
- 6. ENCLOSURE WALLS: 4" ALUMINUM TUBE WELDED FRAME
- 7. ENCLOSURE ROOF: 2" ALUMINUM TUBE WELDED FRAME
- 8. ENCLOSURE DIMENSIONS: 566" L x 168" W x 161" H
- 9. ENCLOSURE WEIGHT (APPROX.): 12,000 LBS
- 10. ENCLOSURE COLOR: 1302 "INDUSTRIAL GREY"
- 11. ENCLOSURE SHALL BE PROVIDED w/ 4-POINT LIFTING LUGS
- 12. TOTAL PACKAGE WEIGHT: 37,363 LBS

Sheet Number	Sheet Title
1	COVER SHEET
2	SPECIAL INSTRUCTIONS
3	ASSEMBLY
4	SALV. 1 ENCLOSURE RIGHT VIEW
5	SALV. 1 ENCLOSURE END VIEW
6	ELECTRICAL PLAN
7	UL 142 DIESEL FUEL TANK
8	INSIDE PLATFORM
9	SUGGESTED PAD LAYOUT
10	ANCHOR DETAIL
11	E1
12	E2
13	E3
14	E4
15	E5

REVISIONS:

REVISION LEVEL	REVISION DESCRIPTION	SHEET OF CHANGE(S)	ENGINEER	DATE
00	INITIAL RELEASE (QUOTE # 94802/REV1)		JAL	10/8/2021
01	REVISED TO REFLECT QUOTE# 94802/REV3		JAL	10/26/2021
02				
03				
04				

DRAWING ACCEPTED FOR PRODUCTION	
SIGNATURE	
PRINT NAME-TITLE	DATE
/	/




1	ENCLOSURE WIND-LOAD RATED AT 120 MPH
2	ENCLOSURE DOORS TO HAVE PAD LOCKABLE PANIC HARDWARE (CRASH BARS), KASON DOOR HANDLE UPGRADE 316SS. INCLUDES HOLD OPEN BRACKETS
3	FUMES DISPOSAL TUBE TO BE ROUTED INTO DISCHARGE FLENUM
4	MOTORIZED INTAKE LOUVERS AND GRAVITY EXHAUST LOUVERS
5	SILENCER, EXHAUST FLANGES, AND EXHAUST FLEXES TO BE WRAPPED IN THERMAL WRAP INSULATION BLANKETS WITH SPRINGS
6	ENCLOSURE ELECTRICAL PACKAGE OPTION THAT INCLUDES A 100 AMP MAIN 3 PHASE PANEL BOARD, UP TO (6) LED LIGHTS, (2) 20A GFCI OUTLETS, AND (2) SWITCHES. ALSO INCLUDES GENERATOR ACCESSORY CONNECTIONS FOR JACKET WATER HEATER, BATTERY CHARGER, AND ALTERNATOR HEATER. INCLUDES INSTALL OF CUSTOMER SUPPLIED BATTERY CHARGER (IF SHIPPED LOOSE).
7	
8	EMERGENCY STOP BUTTON, BREAK GLASS STATION INSTALLED ON ENCLOSURE EXTERIOR, NEMA 4X NONMETALLIC
9	TWO SKY SPACE HEATER WITH THERMOSTAT INSTALLED IN ENCLOSURE
10	TWO EXHAUST FANS AND THERMOSTAT INSTALLED IN ENCLOSURE
11	PROVIDE AND INSTALL TRANSFORMER, 30 KVA 3 PHASE WITH A 60AMP FUSED DISCONNECT
12	ROOF-MOUNTED (2) HEAVY DUTY STEEL DRINGS WITH STAINLESS STEEL PLATE
13	2" AIR GAP UNDERNEATH FUEL TANK FOR VISUAL INSPECTION
14	INSTALL CUSTOMER SUPPLIED OIL LEVELER. INCLUDES TANK BRACKET AND LABOR TO INSTALL. DOES NOT INCLUDE OIL OR FINAL ENGINE RUNNING ADJUSTMENTS
15	7-1/2 GALLON FILLSPILL BUCKET W/ PAD LOCKABLE LID
16	OVERFILL PREVENTION VALVE (2" CAMLOCK CONNECTOR) INSTALLED IN FILLSPILL BUCKET SET @ 90%
17	FUEL FILL EXTENSION FOR STATIC DISCHARGE (FUEL FILL EXTENDED TO 6" FROM BOTTOM OF TANK). USE DROP TUBE ON OPV

18	-LOW FUEL SWITCH (STAINLESS) AT 25% -HIGH FUEL SWITCH (STAINLESS) AT 85% -CRITICAL HIGH FUEL SWITCH (STAINLESS) AT 90% -CRITICAL LOW FUEL SWITCH (STAINLESS) AT 10%
19	INSTALL CUSTOMER SUPPLIED FUEL POLISHER SYSTEM ON FUEL TANK. INCLUDES MOUNTING BRACKET, PIPING, HOSES, ELECTRICAL CONNECTION TO PANEL BOARD
20	NORMAL VENT EXTENSION, 2" NPT X 12' ABOVE GRADE, EXTERIOR TO HOUSING
21	
22	REMOTE ANNUNCIATOR - 5 RED LIGHT (24 VDC) UL LISTED NEMA4 ENCLOSURE STANDARD WITH AUDIBLE ALARM HORN AND SILENCE/RESET BUTTON. TYPICAL ARRANGEMENT FOR CRITICAL HIGH FUEL LEVEL (80%), HIGH FUEL LEVEL (85%) (CITY OF DENVER), LOW FUEL LEVEL (25%), CRITICAL LOW FUEL LEVEL (10%) AND RUPTURE BASIN ALARM POINTS
23	MOUNT GENSET AND INSTALL FUEL LINES, BALL VALVES INSTALLED IN THE SUPPLY LINE TURN LINE TOPFROM THE ENGINE
24	ENCLOSURE TO BE PREPPED FOR SHIPMENT BY CLOSING OFF FLENUM OPENINGS AND EXPOSED ENCLOSURE SIDES THAT WILL OVERHANG FREIGHT CARRIER TRAILER
25	NO SERIES OPTIONS: - NO SERVICIAL COPPER, LEAD, MAGNESIUM, PHOSPHOROUS, POTASSIUM, SODIUM OR ZINC IN FUEL LINE SYSTEM. - STANDARD LOW FUEL SWITCH UPGRADED TO STAINLESS STEEL. - TO USE FACTORY SUPPLIED FUEL LINES TO CONNECT TO TANK. - IF MULTIPLE FUEL LINES ARE NEEDED MFG TO SUPPLY FLEX LINES WITH A STAINLESS STEEL CONNECTION FITTING (JIC).
26	COATING FOR INSIDE OF INNER TANK. (ITL). INCLUDES NEAR-WHITE SAND BLAST
27	SS FUEL LINES IN LIEU OF STANDARD FUEL LINES. 3/8" PER
28	CHECK VALVE INSTALLED IN ENGINE FUEL SUPPLY LINE, 1" FNPT
29	PROVIDE AND INSTALL 240-30 OHM SENDER WIRE TO CONTROL PANEL FOR CUSTOMER TO CONNECT
30	ONE ALUMINUM PLATFORM WITH MOLDED FIBERGLASS GRATING

31	MFG TO SUPPLY FACTORY WITNESS TESTING AT MFG LOCATION PER SPEC FOR THE 1ST UNIT ONLY STORAGE IN THE TANK FOR THIS PROJECT. MFG TO SUPPLY LOAD BANK, TRANSFORMER, CABLING, AND CONNECTIONS FOR TESTING TO BE COMPLETED
32	STAMPED PE DRAWINGS AND CALCULATIONS FOR WIND/SEISMIC CERTIFICATION FOR ENCLOSURE DESIGN TO BE SUPPLIED BY A STATE OF CO PROFESSIONAL ENGINEER
33	THREE YEAR WARRANTY

PLEASE NOTE THAT THE FOLLOWING ITEMS WILL SHIP LOOSE AND REQUIRE ON-SITE ASSEMBLY BY OTHERS

1	NORMAL VENT PIPING
2	EXHAUST ELBOW AND RAIN CAP
3	FUEL TANK
4	GENERATOR
5	ENCLOSURE
6	ONE ALUMINUM PLATFORM

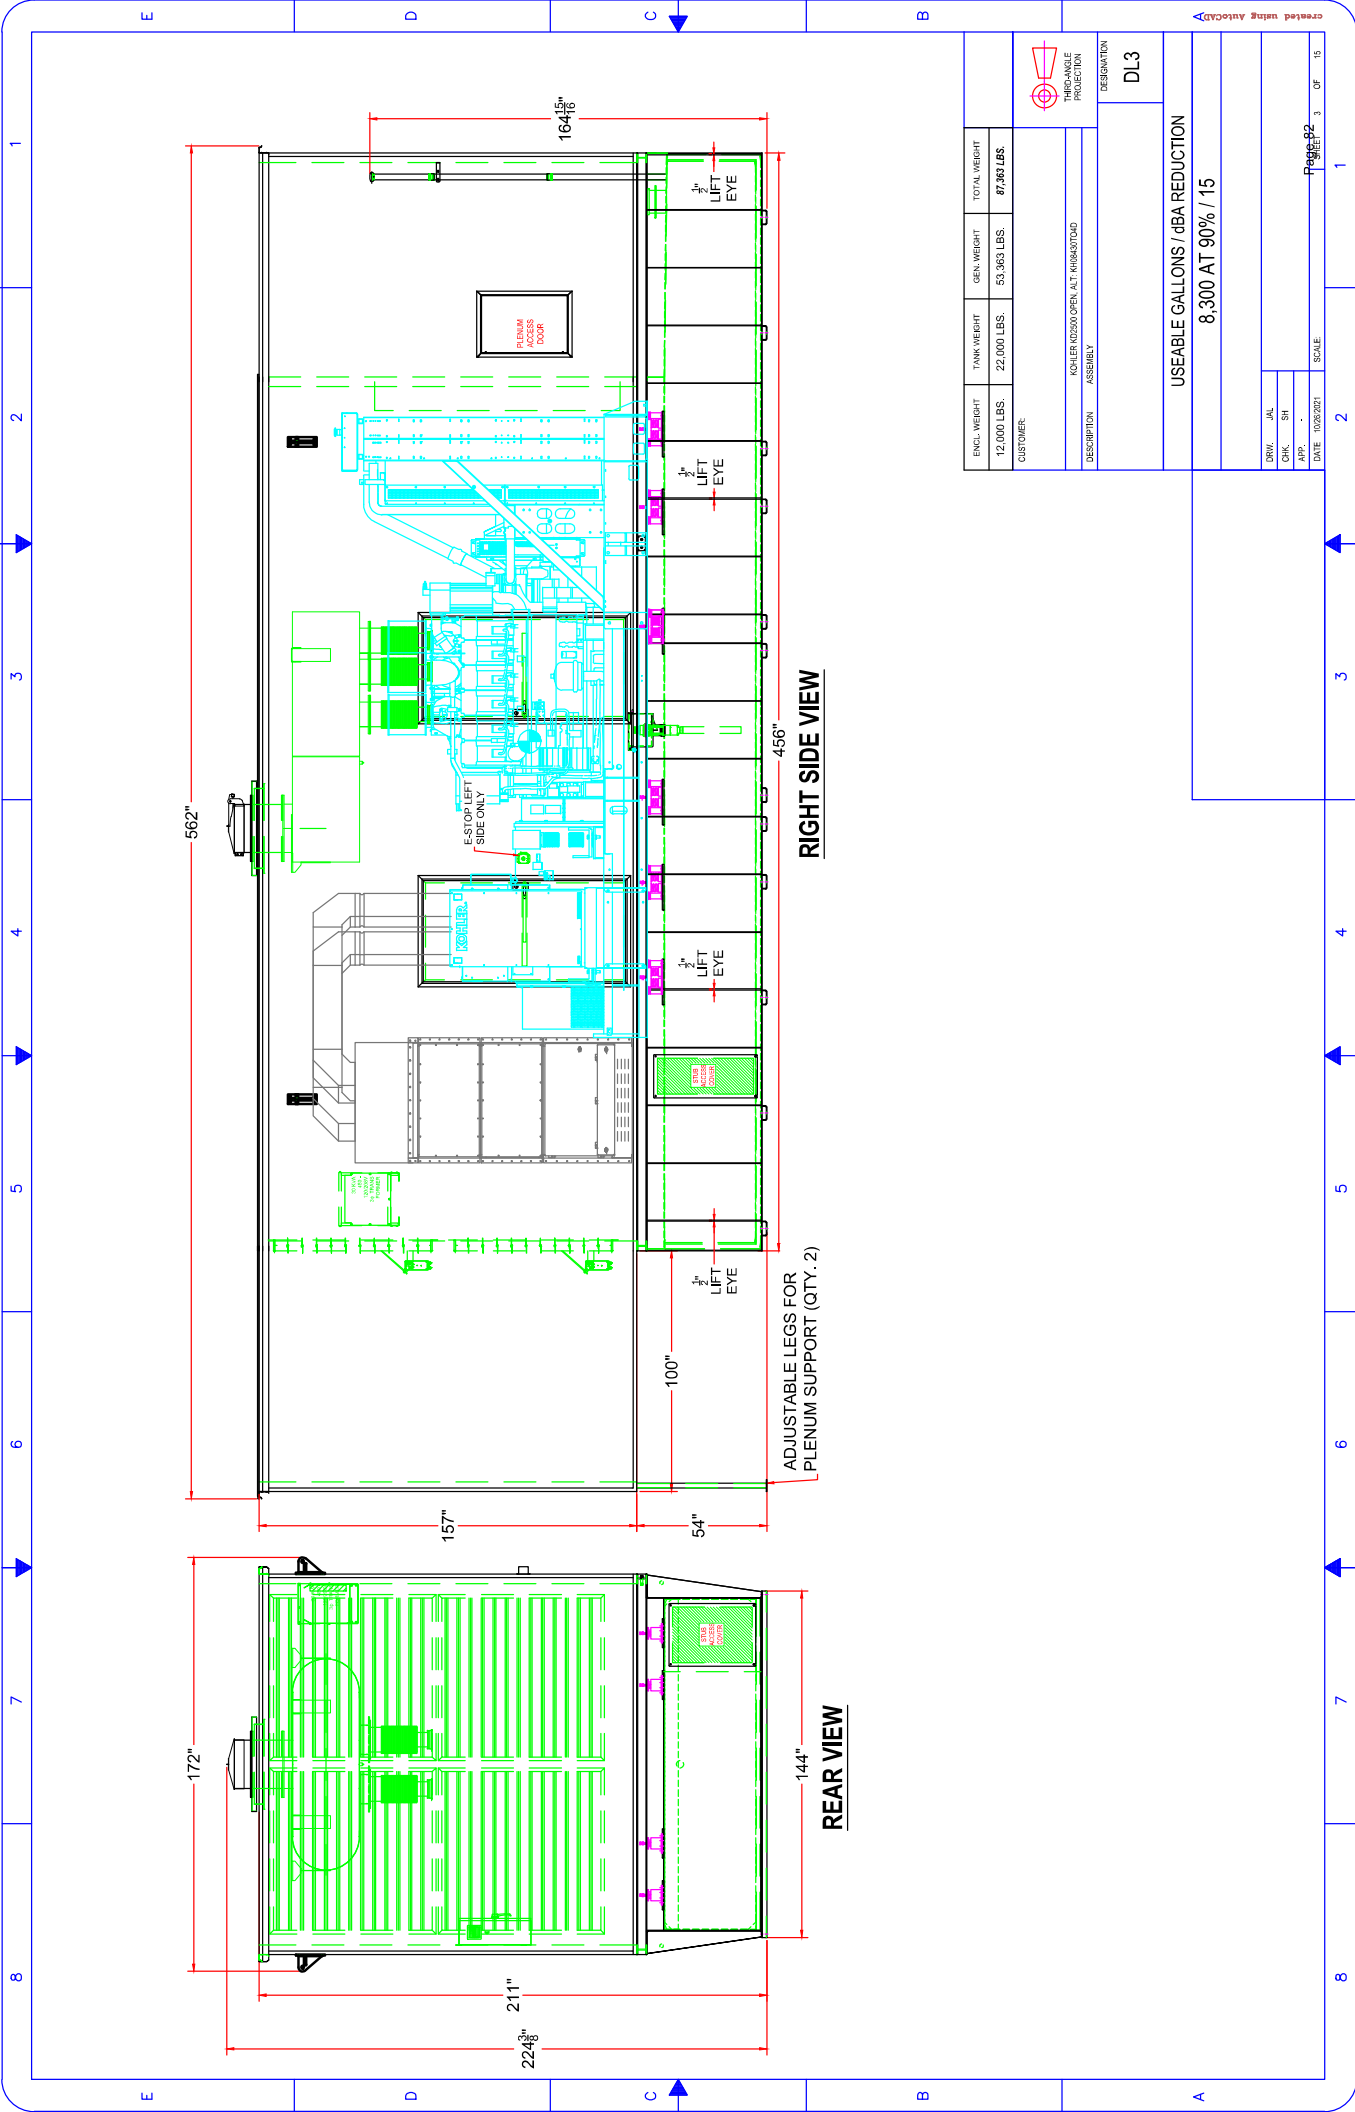


ENCL. WEIGHT	TANK WEIGHT	GEN. WEIGHT	TOTAL WEIGHT
12,000 LBS.	22,000 LBS.	53,965 LBS.	87,965 LBS.

THERMO-ABLE PRODUCTION	
DESCRIPTION	KOHLER-D/2000 OPEN, ALT. 1498437000
DESIGNATION	ASSEMBLY

DL3
USEABLE GALLONS / dBA REDUCTION
8,300 AT 90% / 15

DATE	10/02/2021	SCALE	1
DRAWN BY	DL	CHECKED BY	SH
DATE	10/02/2021	SCALE	1
Page 2		3 of 15	

1 2 3 4 5 6 7 8

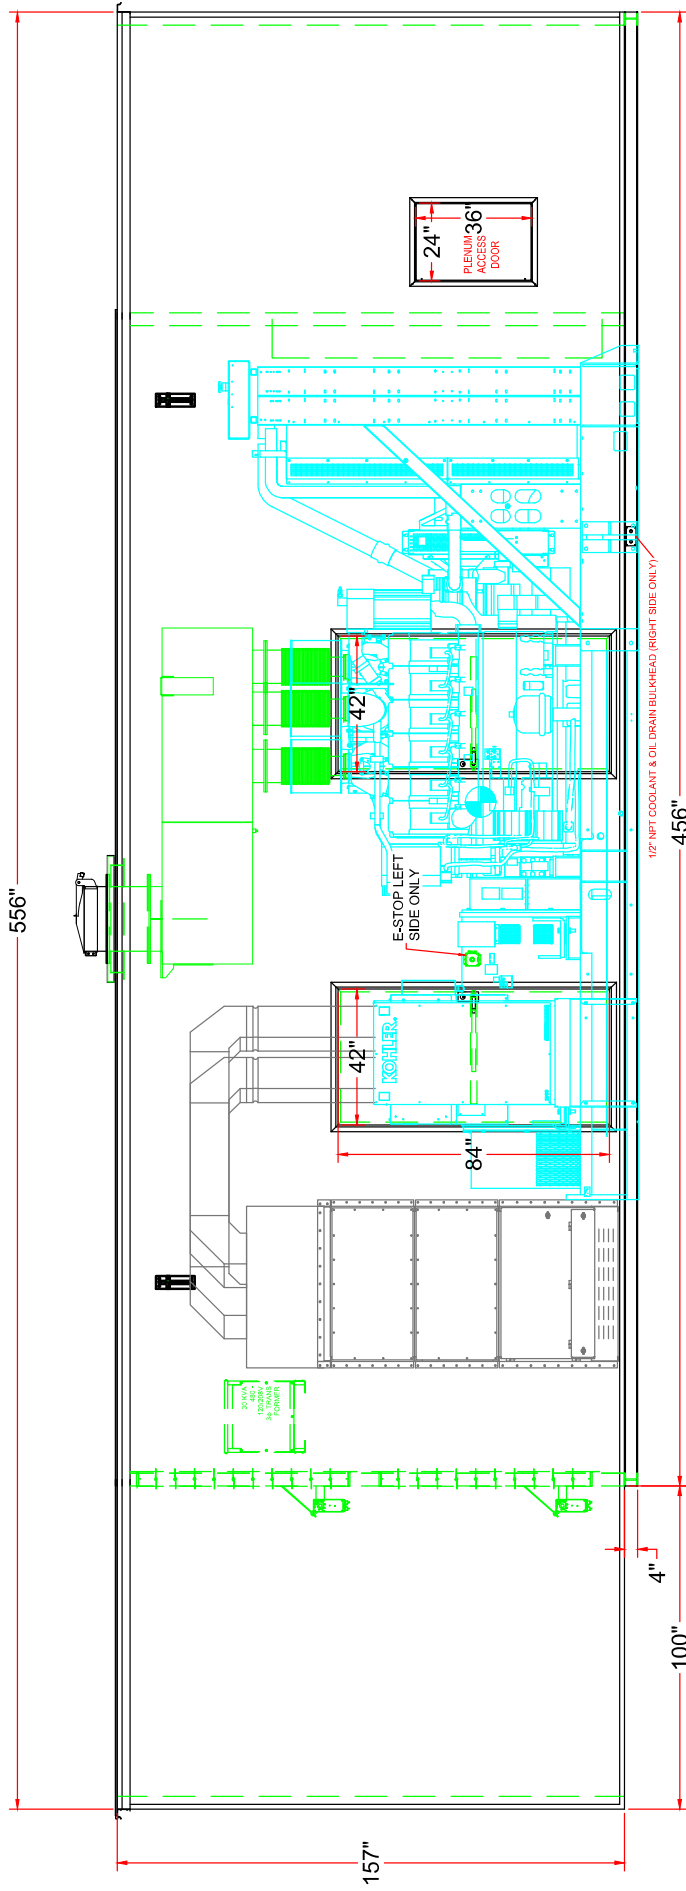

EXHAUST LIST		PART #
QTY.	PART	
1	18" RAINCAP	
1	20" EXHAUST STACK, 20" ANSI FLANGE O.E., 7.25" OAL	
1	20" EXHAUST STACK, 20" ANSI FLANGE O.E., 20" FLOATING ANSI FLANGE O.E., 12.75" OAL	
1	20" O-SERIES CRITICAL GRADE SILENCER	
1	INSULATION BLANKET W/ SPRINGS FOR SILENCER	
1	20" ANSI FLANGE GASKET	
2	20" ANSI NUT, BOLT, GASKET KIT	
3	10" ANSI NUT, BOLT, GASKET KIT	
1	INSULATION BLANKET W/ SPRINGS FOR 20" ANSI FLANGE	
3	INSULATION BLANKET W/ SPRINGS FOR 10" ANSI FLANGE	
3	6" CUSTOM FLARED FLANGE / 10" ANSI FLOATING FLANGE 26" FLEX ASSEMBLY	
3	INSULATION BLANKET W/ SPRINGS FOR FLEX	


ENCL. WEIGHT	12,000 LBS.	TANK WEIGHT	22,000 LBS.	GEN. WEIGHT	53,965 LBS.	TOTAL WEIGHT	87,965 LBS.
--------------	-------------	-------------	-------------	-------------	-------------	--------------	-------------

CUSTOMER:
 THRO-ANGLE PRODUCTION
 DESCRIPTION: KÖHLER K0300 OPEN, ALT. 14984307000
 SALUL T ENCL. ENCLOSURE RIGHT VIEW

DESIGNATION:
 DL3

dBA REDUCTION:
 15

DRW.	DL	DATE	10/08/2021
CHK.	SH	SCALE	1
APP.		SHEET	4 OF 15

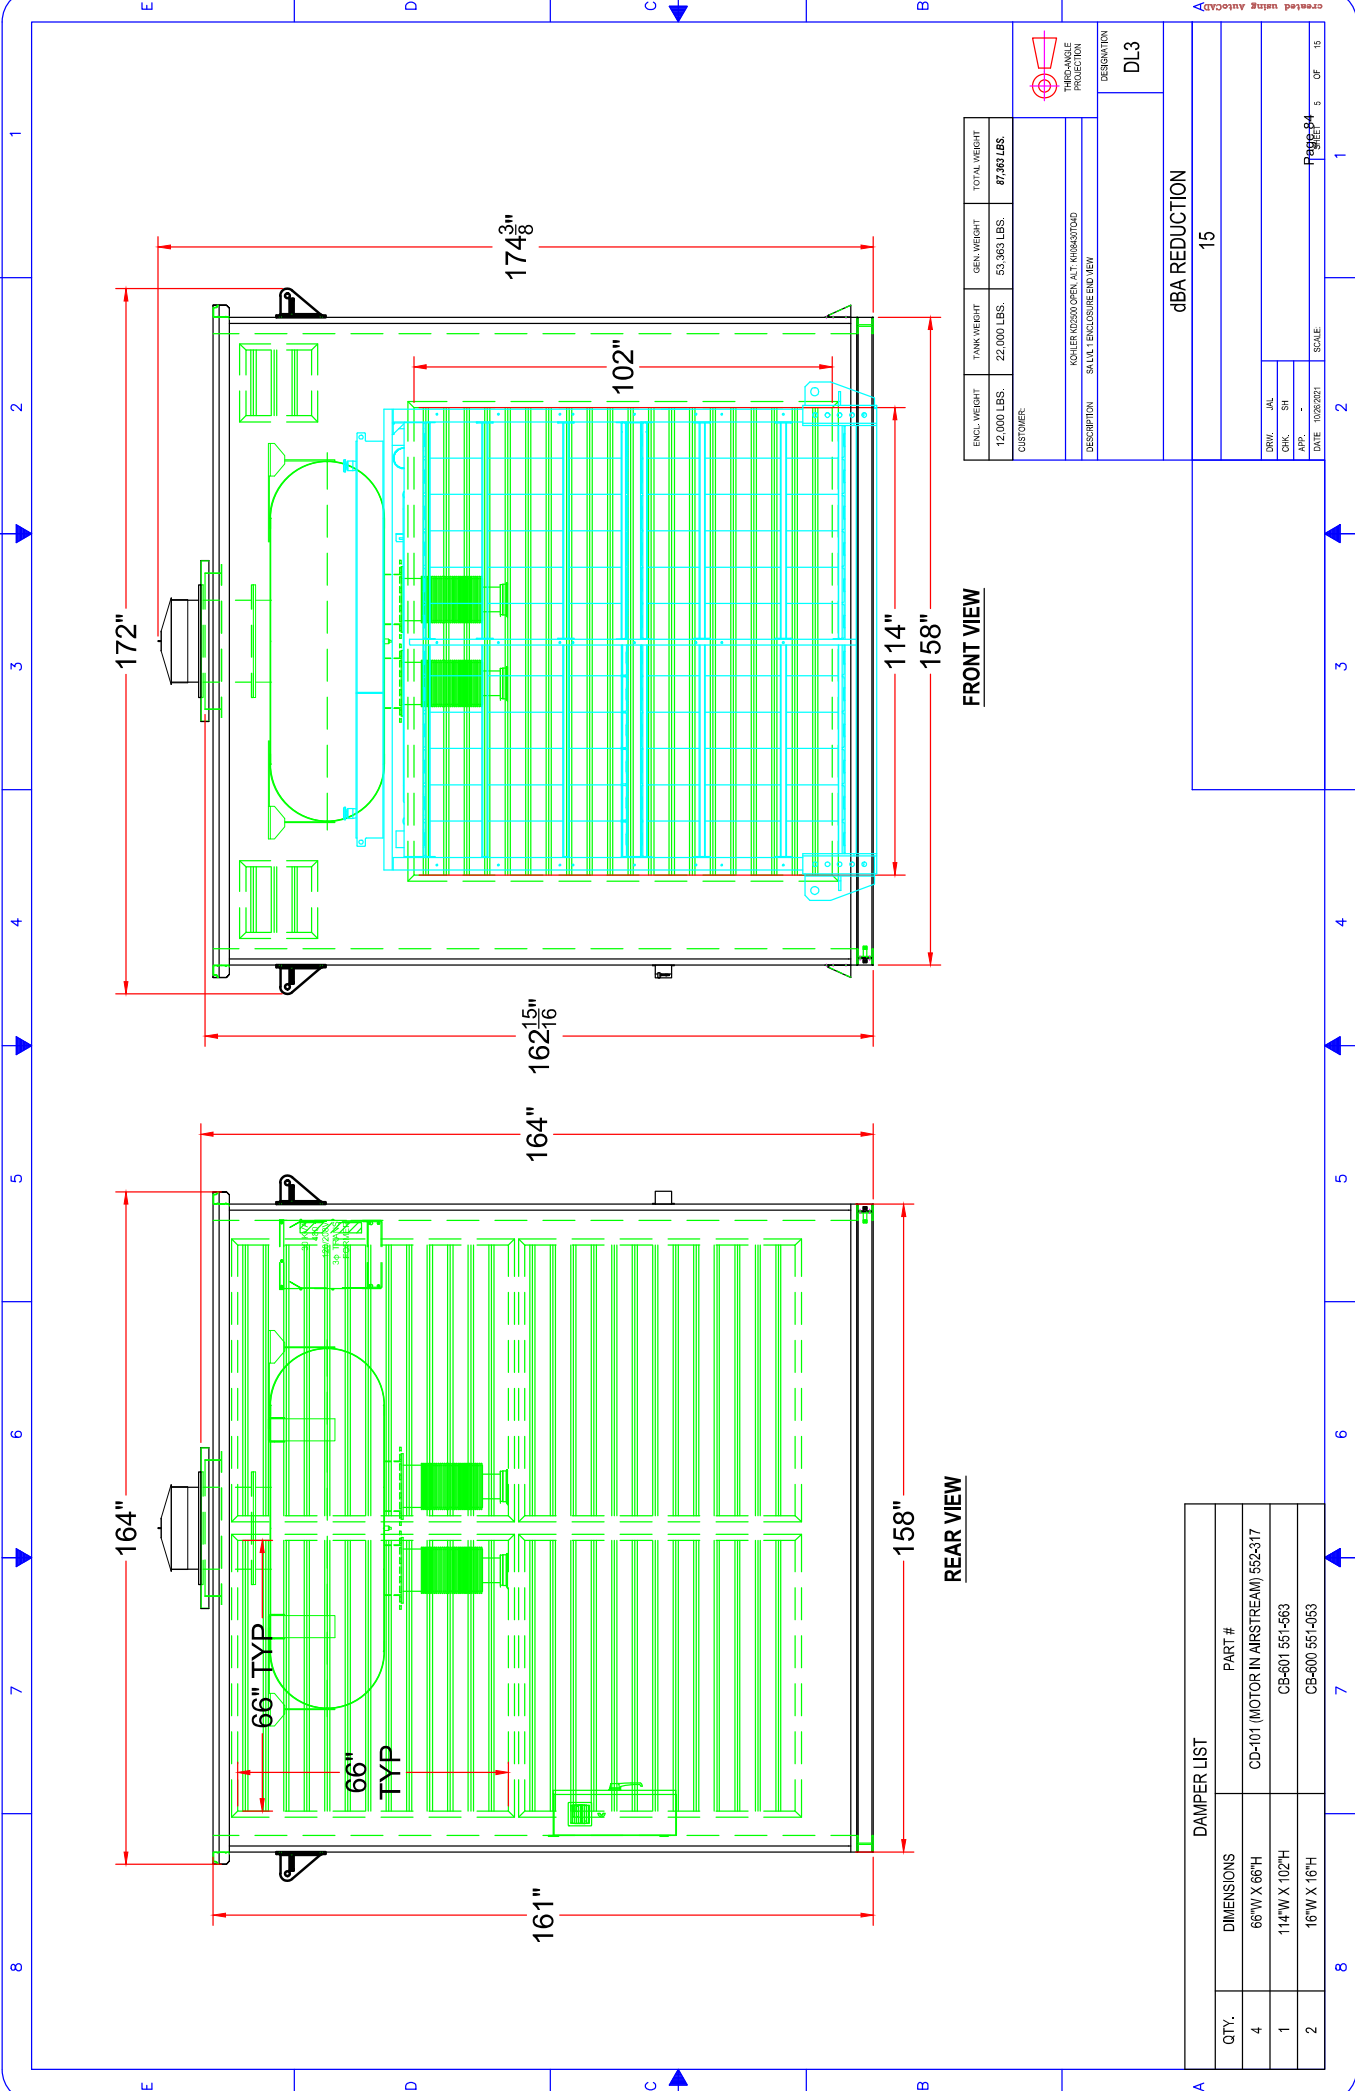

FRONT VIEW

REAR VIEW

ENCL. WEIGHT	TANK WEIGHT	GEN. WEIGHT	TOTAL WEIGHT
12,000 LBS.	22,000 LBS.	53,965 LBS.	87,965 LBS.


CUSTOMER:
 THRO-ANGLE PRODUCTION
 DESCRIPTION: KOHLER 10200 OPEN, ALT. 1498437000
 SALUL T ENCLASURE END VIEW

DESIGNATION: **DL3**

dBA REDUCTION
 15

DRW. NO.	REV.	DATE	SCALE
DL3	01	10/08/2021	1:1

DAMPER LIST	
QTY.	PART #
4	CD-101 (MOTOR IN AIRSTREAM) 552-317
1	CB-801 551-563
2	CB-800 551-053

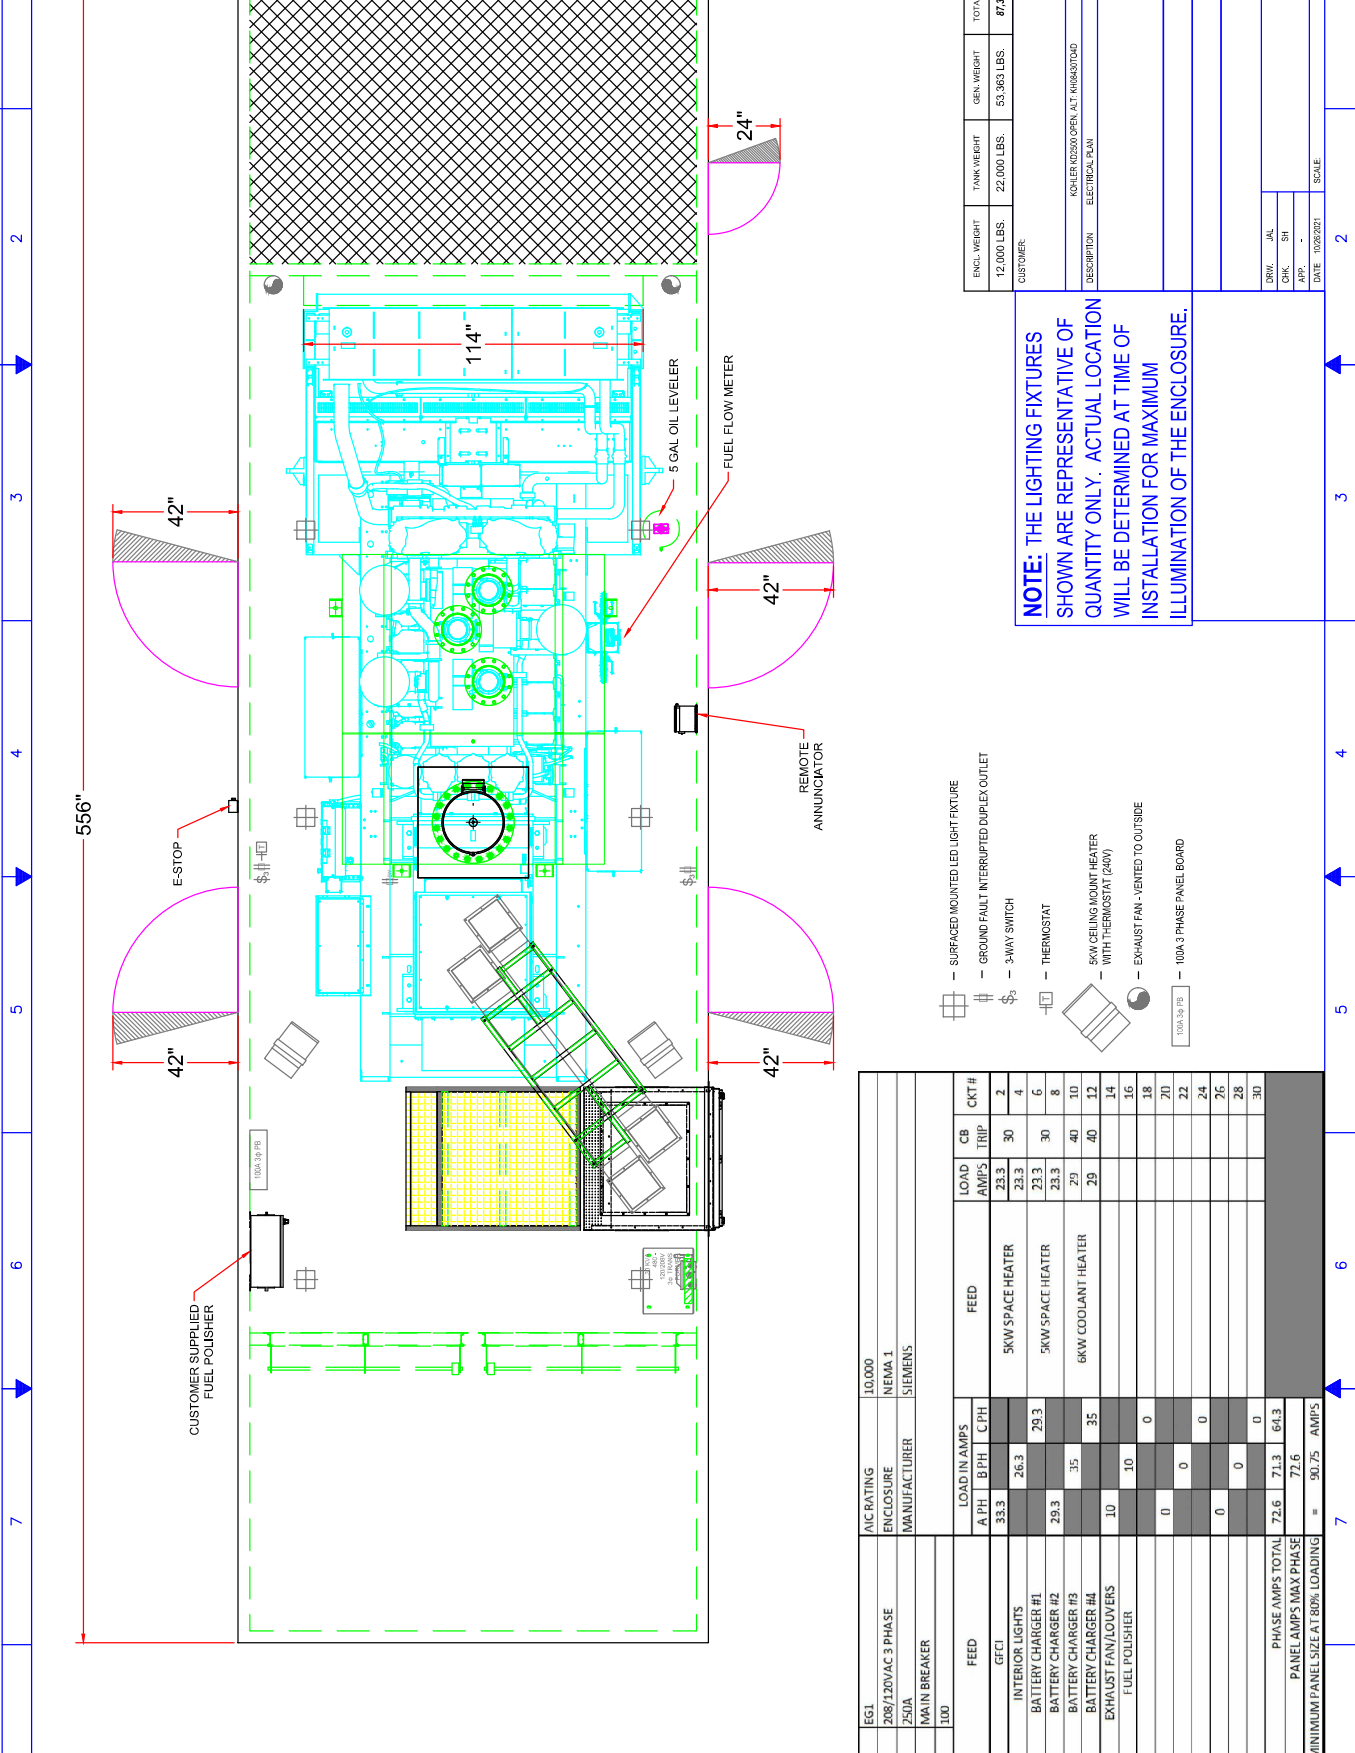


ENCL. WEIGHT	12,000 LBS.	TANK WEIGHT	22,000 LBS.	GEN. WEIGHT	53,965 LBS.	TOTAL WEIGHT	87,965 LBS.
CUSTOMER:							
KOHLER 10000 OPEN ALT 1498437000							
ELECTRICAL PLAN							

NOTE: THE LIGHTING FIXTURES SHOWN ARE REPRESENTATIVE OF QUANTITY ONLY. ACTUAL LOCATION WILL BE DETERMINED AT TIME OF INSTALLATION FOR MAXIMUM ILLUMINATION OF THE ENCLOSURE.

- SURFACE MOUNTED LED LIGHT FIXTURE
- GROUND FAULT INTERRUPTED DUPLEX OUTLET
- 3-WAY SWITCH
- THERMOSTAT
- 5KW CEILING MOUNT HEATER WITH THERMOSTAT (240V)
- EXHAUST FAN - VENTED TO OUTSIDE
- 100A-3P FBS
- 100A-3 PHASE PANEL BOARD

PANEL DESIGNATION	EG1	VOLTAGE AND PHASE	AIC RATING	ENCLOSURE	NEMA 1	10,000	LOAD IN AMPS			FEED	LOAD AMPS	CB TRIP	CKT #
							A PH	B PH	C PH				
MANUFACTURER: SIEMENS													
MAIN TYPE: MAIN BREAKER													
MAIN AMPS: 100													
1	20	10	33.3				26.3		5KW SPACE HEATER	23.3	30	2	
3	20	3					29.3		5KW SPACE HEATER	23.3	30	4	
5	20	6					35		6KW COOLANT HEATER	29	40	6	
7	20	6					10		FUEL POLISHER	29	40	8	
9	20	6										10	
11	20	6										12	
13	20	10										14	
15	20	10										16	
17												18	
19												20	
21												22	
23												24	
25												26	
27												28	
29												30	
PHASE AMPS TOTAL										72.6	71.3	64.3	
PANEL AMPS MAX PHASE										72.6			
MINIMUM PANEL SIZE AT 80% LOADING										= 90.75 AMPS			

Page 65 of 15

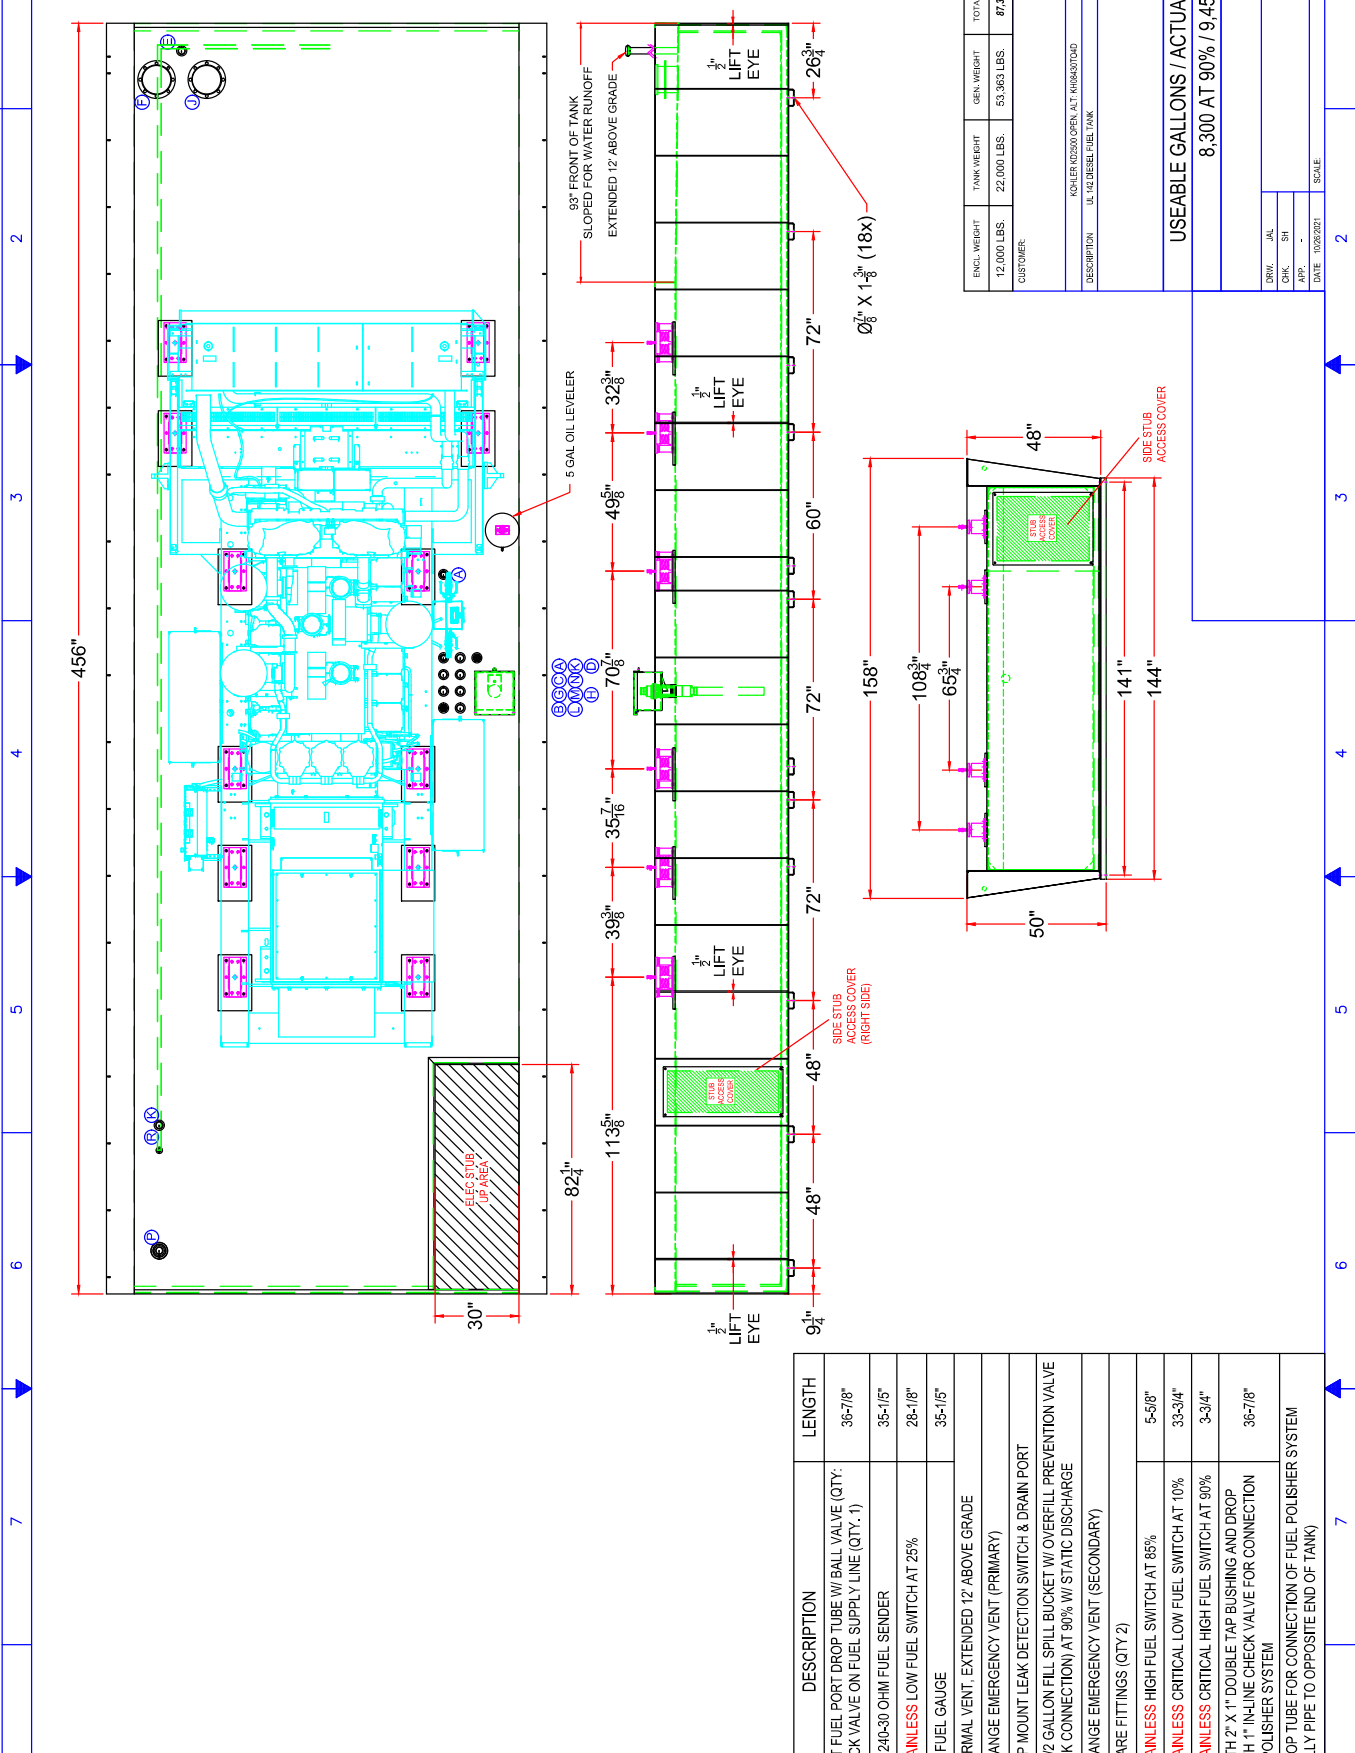

ENCL. WEIGHT	12,000 LBS.	TANK WEIGHT	22,000 LBS.	GEN. WEIGHT	53,365 LBS.	TOTAL WEIGHT	87,382 LBS.
CUSTOMER:							
KCHLER10200 OPEN, ALT. FUEL TANK							
DESCRIPTION: UL 142 DIESEL FUEL TANK							
DESIGNATION: DL3							

USEABLE GALLONS / ACTUAL GALLONS
8,300 AT 90% / 9,458

DRAWN BY	AL	CHECKED BY	SH	DATE	10/02/2021	SCALE	1
Page 6 of 15							1

FITTING	DESCRIPTION	LENGTH
A	2" X 1" NPT FUEL PORT DROP TUBE W/ BALL VALVE (QTY: 2) W/ CHECK VALVE ON FUEL SUPPLY LINE (QTY: 1)	36-7/8"
B	1-1/2" NPT 240-30 OHM FUEL SENDER	35-1/5"
C	2" NPT STAINLESS LOW FUEL SWITCH AT 25%	28-1/8"
D	1-1/2" NPT FUEL GAUGE	35-1/5"
E	2" NPT NORMAL VENT, EXTENDED 12" ABOVE GRADE	
F	8" ANSI FLANGE EMERGENCY VENT (PRIMARY)	
G	2" NPT TOP MOUNT LEAK DETECTION SWITCH & DRAIN PORT	
H	4" NPT 7-1/2 GALLON FILL SPILL BUCKET W/ OVERFILL PREVENTION VALVE (2" CAMLOCK CONNECTION) AT 90% W/ STATIC DISCHARGE	
J	8" ANSI FLANGE EMERGENCY VENT (SECONDARY)	
K	2" NPT SPARE FITTINGS (QTY 2)	
L	2" NPT STAINLESS HIGH FUEL SWITCH AT 85%	5-5/8"
M	2" NPT STAINLESS CRITICAL LOW FUEL SWITCH AT 10%	33-3/4"
N	2" NPT STAINLESS CRITICAL HIGH FUEL SWITCH AT 90%	3-3/4"
P	2" NPT WITH 2" X 1" DOUBLE TAP BUSHING AND DROP TUBE WITH 1" IN-LINE CHECK VALVE FOR CONNECTION OF FUEL POLISHER SYSTEM	36-7/8"
R	1" NPT DROP TUBE FOR CONNECTION OF FUEL POLISHER SYSTEM (INTERNALLY PIPE TO OPPOSITE END OF TANK)	

2500 KW Kohler Generator Foundation Design

IBC 2018, ASCE 7-16, ACI 318-14

1.) Generator

Enclosure Weight:	12.0 kips	Total Height H:	211 in
Generator Weight:	53.4 kips	Total Width B:	158 in
Tank Weight:	22.0 kips	Total Width L:	562 in
Tank Capacity:	9458 gal	Tank Int. Height H_T :	37.74 in
Liquid S.G.:	0.88	Tank Int. Width W_T :	137.88 in
Liquid Weight:	69.4 kips	Tank Int. Length L_T :	450.5 in
Snow Load:	25 psf		

2) Seismic Design per ASCE 7-16 Chapter 15 Non-Building Structure Procedure

Lateral System

Flat Bottom Ground Supported
Steel Tanks Mechanically Anchored

R:	3.0	ASCE Table 15.4-2
Ω_0 :	2.0	ASCE Table 15.4-2
C_d :	2.5	ASCE Table 15.4-2
I_E :	1.25	


Lateral Loads

Lateral resistance is provided by the steel tank anchored to the concrete slab.
See Ground Supported Tank For Liquids Seismic Design Spreadsheet

$V_i =$	0.42 W_i	ASCE EQ 15.7-5
$V_c =$	0.33 W_i	ASCE EQ 15.7-6

Enclosure EQ = $V_i * W_e =$	5.1 kips
Generator EQ = $V_i * W_g =$	22.5 kips
Tank EQ = $V_i * W_t =$	9.3 kips

Liquid $W_i =$	25.0 kips	ACI 350.3-06 EQ 9-15
Liquid $W_c =$	4.1 kips	ACI 350.3-06 EQ 9-16
Liquid EQ = $V_i * W_i + V_c * W_c =$	11.9 kips	

 Quantum Consulting Engineers LLC 1511 Third Avenue, Suite 323 Seattle, WA 98101	Project: Centeris Data Centers	Date: 2/2/24	Job No: 23444.01
	Client: Benaroya	Designer: TVM	Sheet: 1
	Checked:		

2500 KW Kohler Generator Foundation Design

IBC 2018, ASCE 7-16, ACI 318-14

2) Seismic Design per ASCE 7-16 Chapter 15 Non-Building Structure Procedure

Shear Connection

$V = \Sigma EQ =$ 48.7 kips Kohler spec calls for a 3/4" Hilti KB3 SS
 Number of Anchors = 24.0 with 3 1/4" embed.
 Anchor Shear = $0.7 * V * \Omega / \# =$ 2.84 kips/anchor < ASD Capacity = 5.7 kips OK

Overturing Resistance About Width

	C.O.G.	EQ	OT Moment
Enclosure	132.5 in	5.1 kips	55.8 k-ft
Generator	93.3 in	22.5 kips	175 k-ft
Tank	24.0 in	9.3 kips	18.5 k-ft
Liquid	24.0 in	11.9 kips	23.8 k-ft
		$M_{OT} =$	273 k-ft
	Moment Arm	DL	Res. Moment
Resisting Dead Load	79 in	87.4 kips	575 k-ft
Resisting Liquid	79 in	69.4 kips	457 k-ft
		$M_R =$	1032 k-ft
F.O.S. = $M_R / M_{OT} =$	3.8 OK Full Tank		
F.O.S. = $M_R / M_{OT} =$	2.3 OK Empty Tank		

3) Wind Design per ASCE 7-16 Chapter 29 Non-Building Structure Procedure

Wind Speed V: 104.0 mph ASCE 7-16 Risk Category III
 Exposure Cat. B
 Exposure Coe Kz: 0.62 Table 26.10-1 (H = 20')
 Direction Coe. Kd: 0.85 Table 26.6-1
 Topo Coe. Kzt: 1.00 Sec. 26.8

 V_Pressure qz = 14.6 psf EQ 26.10-1
 Gust Factor G: 0.85 Sec 26.11
 Af = 823 sqft
 h/d = 1.34
 Cf = 1.31 Figure 29.4-1
 F = 13.3802 kips EQ 29.4-1

Shear Connection

WL < EQ Shear Connection OK By Inspection

Overturing Resistance About Width

$M_{OT} = F * H / 2$ 118 k-ft
 $M_R = DL * W / 2$ 575 k-ft (Exclude Liquid Weight)
 F.O.S. = $M_R / M_{OT} =$ 4.9 OK



Quantum Consulting Engineers LLC
 1511 Third Avenue, Suite 323
 Seattle, WA 98101

Project: Centeris Data Centers

Date: 2/2/24

Job No: 23444.01

Designer: TVM

Sheet: 2

Client: Benaroya

Checked:

2500 KW Kohler Generator Foundation Design

IBC 2018, ASCE 7-16, ACI 318-14

4) Foundation Design

Bearing Analysis

Allowable Bearing	2000	psf
Footing Width:	40	ft
Footing Length:	14	ft
Thickened Edge Width:	1	ft

Dead Load (Full):	157	kips
Snow Load:	15.4	kips
1.0DL+1.0SL Pressure:	1595	psf < 2000 psf OK


Earthquake OT (Full)	273	k-ft
Applied Pressure:	487	psf
1.15DL+0.7EQ Pressure:	2011	psf < 2000 psf * (4/3) OK

Sliding Analysis

Slab-on-Grade Thickness	8	in
-------------------------	---	----

Allow. Coefficient of Friction:	0.3	
(0.7) Earthquake (Full):	34.1	kips
Dead Load (Full):	213	kips Includes Slab-on-Grade Weight
Sliding Resistance:	63.8499	kips
Unity Check $U_c =$	1.87	> 1.0 OK

(0.7) Earthquake (Empty)	25.7	kips
Dead Load (Empty):	143	kips Includes Slab-on-Grade Weight
Sliding Resistance:	43.0	kips
Unity Check $U_c =$	1.67	> 1.0 OK

 Quantum Consulting Engineers LLC 1511 Third Avenue, Suite 323 Seattle, WA 98101	Project: Centeris Data Centers	Date: 2/2/24	Job No: 23444.01
		Designer: TVM	Sheet: 3
	Client: Benaroya	Checked:	



KWIK Bolt 3 Expansion Anchor 3.3.6**Table 8 - Stainless Steel KWIK Bolt 3 Allowable Loads in Normal-Weight Concrete¹**

Anchor Diameter in. (mm)	Embedment Depth in. (mm)	$f'_c = 2000$ psi (13.8 MPa)		$f'_c = 3000$ psi (20.7 MPa)		$f'_c = 4000$ psi (27.6 MPa)		$f'_c = 6000$ psi (41.4 MPa)	
		Tension lb (kN)	Shear lb (kN)	Tension lb (kN)	Shear lb (kN)	Tension lb (kN)	Shear lb (kN)	Tension lb (kN)	Shear lb (kN)
1/4 (6.4)	1-1/8 (29)	260 (1.2)	595 (2.6)	320 (1.4)	675 (3.0)	380 (1.7)	725 (3.2)	470 (2.1)	805 (3.6)
	2 (51)	540 (2.4)	675 (3.0)	625 (2.8)		705 (3.1)	805 (3.6)	910 (4.0)	
	3 (76)	685 (3)		750 (3.3)		810 (3.6)			
3/8 (9.5)	1-5/8 (41)	605 (2.7)	880 (3.9)	670 (3.0)	1110 (4.9)	730 (3.2)	1345 (6.0)	950 (4.2)	1690 (7.5)
	2-1/2 (64)	1285 (5.7)	1570 (7.0)	1430 (6.4)	1570 (7.0)	1575 (7.0)	1590 (7.1)	1940 (8.6)	1590 (7.1)
	3-1/2 (89)	1620 (7.2)		1755 (7.8)		1885 (8.4)		2035 (9.1)	
1/2 (12.7)	2-1/4 (57)	1015 (4.5)	1875 (8.3)	1230 (5.5)	2130 (9.5)	1450 (6.4)	2380 (10.6)	1620 (7.2)	2740 (12.2)
	3-1/2 (89)	1445 (6.4)	3010 (13.4)	1975 (8.8)	3010 (13.4)	2510 (11.2)	3045 (13.5)	2655 (11.8)	3045 (13.5)
	4-3/4 (121)	1990 (8.9)		2250 (10.0)		2985 (13.3)			
5/8 (15.9)	2-3/4 (70)	1650 (7.3)	2875 (12.8)	1755 (7.8)	3485 (15.5)	1860 (8.3)	4095 (18.2)	2335 (10.4)	4625 (20.6)
	4 (102)	2455 (10.9)	4625 (20.6)	2900 (12.9)	4625 (20.6)	3340 (14.9)	4625 (20.6)	4395 (19.5)	
	5-1/2 (140)	3480 (15.5)		3885 (17.3)		4290 (19.1)		6260 (27.8)	
3/4 (19.1)	3-1/4 (83)	1550 (6.9)	3945 (17.5)	1950 (8.7)	4260 (18.9)	2350 (10.5)	5645 (25.1)	2610 (11.6)	5645 (25.1)
	4-3/4 (121)	2510 (11.2)	5535 (24.6)	3250 (14.5)	5535 (24.6)	3870 (17.2)		4670 (20.8)	
	8 (203)	2930 (13.0)		3735 (16.6)		4530 (20.2)		5120 (22.9)	
1 (25.4)	4-1/2 (114)	3120 (13.9)	6080 (27.0)	3870 (17.2)	6770 (30.1)	4610 (20.5)	7470 (33.2)	4800 (21.4)	7470 (33.2)
	6 (152)	4400 (19.6)	7470 (33.2)	6400 (28.5)	7470 (33.2)	7200 (32.0)		7330 (32.6)	
	9 (229)	5600 (24.9)		8000 (35.6)		9390 (41.8)		9390 (41.8)	

¹ Intermediate load values for other concrete strengths and embedments can be calculated by linear interpolation.

DWG NO. 0073180093.842	
HOWARD INDUSTRIES INC.	
LAUREL, MISS. USA 39440	
THREE PHASE PAD DISTRIBUTION TRANSFORMERS	
CUSTOMER : CORE	
SPEC. CORE	DATED
KVA 3000.0 BIL 95 TAPS SPECIAL	
HIGH VOLTAGE 13200	
LOW VOLTAGE 480Y/277	
APPROX. CORE AND COIL WEIGHT	7261
APPROX. TANK AND ACCESS. WEIGHT	3166
GAL. OF OIL 560 J APPROX. WEIGHT	4201
APPROX. TOTAL WEIGHT	14628
REV. DATE	DESCRIPTION
A	BY APP

0073180093.842

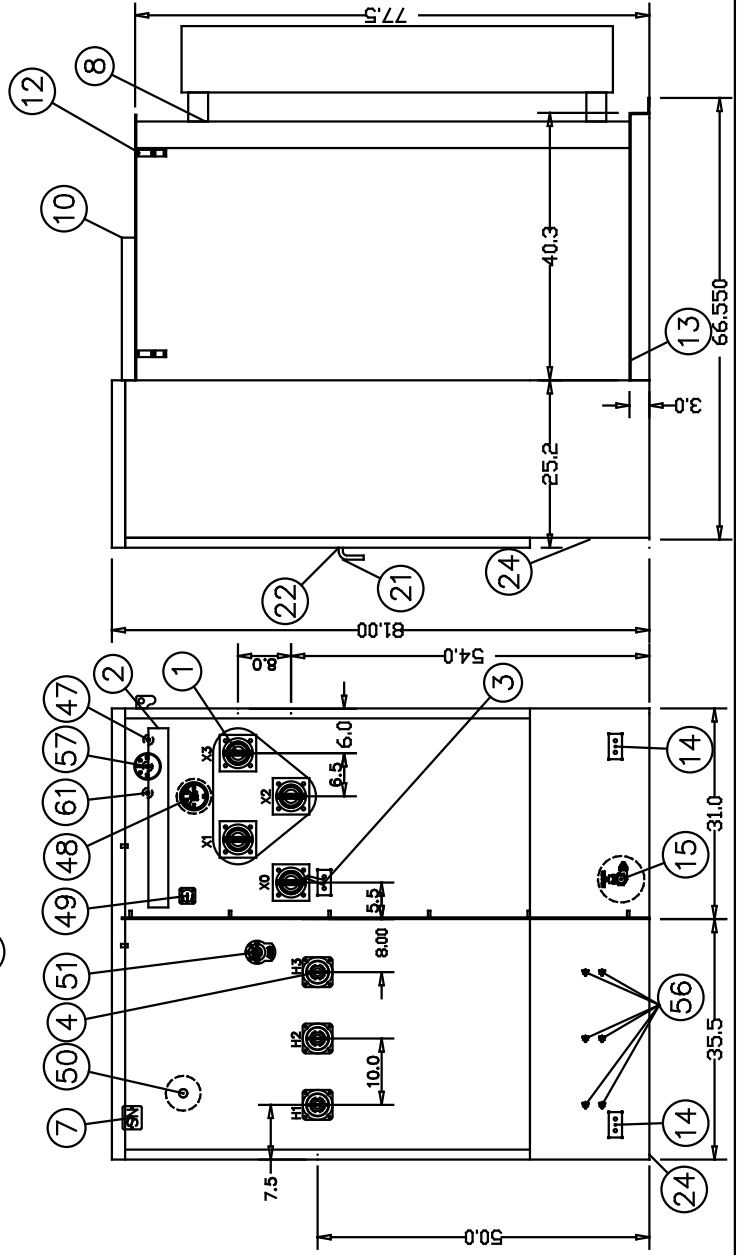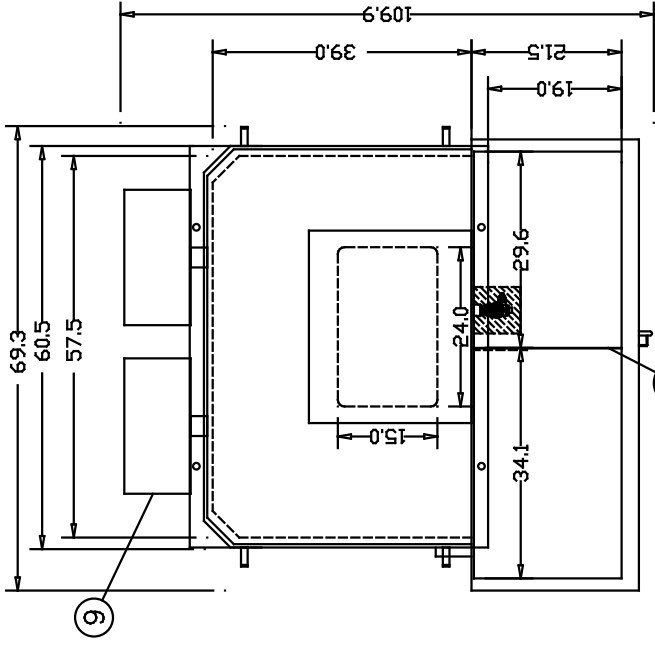

DESCRIPTION	
1 LV BUSHING W/INT. 10H SPADE	
2 LV SPADE SUPPORT	
3 2 HOLE HORIZ NEMA GRD PAD	
4 HV PORC 95BIL W/2H G-SPADE	
7 NP ON DOOR, SERIAL ON TANK	
8 TANK	
9 COOLING RADIATORS	
10 HANDHOLE & SECURITY COVER	
12 LIFTING LUGS	
13 JACKING PROVISIONS	
14 2 HOLE HORIZ NEMA GRD PAD	
15 1 IN DRAIN VALVE AND SAMPLER	
21 PADLOCKABLE DOOR HANDLE	
22 3 PT LATCH PENTA SEC BOLT	
24 18 IN REMOVABLE SILL	
25 METAL LV-HV BARRIER	
47 PRV VIAT 301-010-01N	
48 DIAL THERM W/MAX POINTER	
49 2" MAGNETIC LL GAUGE	
50 OIL LEVEL PLUG	
51 TAP CHANGER HANDLE	
56 PROVISIONS FOR LTG ARR	
57 PRES VAC GAUGE	
61 SCHRADER BLEED VALVE	
SPECIAL NOTES	
A	
B	
C	
D	
E	
CAT NO	9397435696028
DWG BY	JF
DATE	08/24/22
APP BY:	CM
CC	745

3000 KVA Transformer Anchorage & Foundation Design

IBC 2018, ASCE 7-16, ACI 318-14

2.) Transformer

Weight: 14.6 kips
 Total Height H: 81 in
 Total Width B: 69.3 in
 Total Width L: 109.9 in
 Center of Gravity: 54 in
 Snow Load: 25 psf

2) Seismic Design per ASCE 7-16 Chapter 13 Non-Structural Components

Electrical Components

ap = 1
 Rp = 2.5
 Sds = 1.01
 Ie = 1.25

Lateral Loads

Lateral resistance is provided by the transformer anchored to the concrete slab.

Fp = 2.96 kips ASCE 7-16 EQ 13.3-1
 X Fpmin = 5.54 kips ASCE 7-16 EQ 13.3-2 Controls
 Fpmax = 29.55 kips ASCE 7-16 EQ 13.3-3

EQ = 5.54 kips

Shear Connection

Number of Anchors = 2.0 3/4" Titen HD Screw Anchors
 with 4 1/2" Embed
 Anchor Shear = $V \cdot \Omega / \# = 2.77$ kips/anchor < Capacity = 7.1 kips OK

Overturning Resistance About Width

	C.O.G.	EQ	OT Moment
transformer	54 in	5.5 kips	24.9 k-ft

	Moment Arm	DL	Res. Moment
Resisting Dead Load	20 in	14.6 kips	24 k-ft

F.O.S. = $M_R / M_{OT} = 1.0$ Use Tension Capacity of Anchors

Anchor Tension = $M / d / \# = 7.5$ kips/anchor < Capacity = 35.7 kips OK

3000 KVA Transformer Anchorage & Foundation Desig

IBC 2018, ASCE 7-16, ACI 318-14

3) Wind Design per ASCE 7-16 Chapter 29 Non-Building Structure Procedure

Wind Speed V:	104.0	mph	ASCE 7-16 Risk Category III
Exposure Cat.	B		
Exposure Coe Kz:	0.62		Table 26.10-1 (H = 20')
Direction Coe. Kd:	0.85		Table 26.6-1
Topo Coe. Kzt:	1.00		Sec. 26.8
V_Pressure qz =	14.6	psf	EQ 26.10-1
Gust Factor G:	0.85		Sec 26.11
Af =	62	sqft	
h/d =	1.17		
Cf =	1.30		Figure 29.4-1
F =	1.00	kips	EQ 29.4-1

Shear Connection

WL < EQ Shear Connection OK By Inspection

Overturing Resistance About Width

$M_{OT} = F \cdot H / 2$	3	k-ft
$M_R = DL \cdot W / 2$	42	k-ft
F.O.S. = $M_R / M_{OT} =$	12.6	OK



Quantum Consulting Engineers LLC
1511 Third Avenue, Suite 323
Seattle, WA 98101

Project: Centeris Data Centers

Date: 2/2/24

Job No: 23444.01

Designer: TVM

Sheet: 2

Client: Benaroya

Checked:

3000 KVA Transformer Anchorage & Foundation Desig

IBC 2018, ASCE 7-16, ACI 318-14

4) Foundation Design

Bearing Analysis

Allowable Bearing	2000 psf
Footing Width:	6.5 ft
Footing Length:	6.5 ft
Thickened Edge Width:	1.0 ft

Dead Load:	15 kips
Snow Load:	1.1 kips
1.0DL+1.0SL Pressure:	603 psf < 2000 psf OK

Earthquake OT	25 k-ft
Applied Pressure:	590 psf
1.15DL+0.7EQ Pressure:	1060 psf < 2000 psf * (4/3) OK

Sliding Analysis

Slab-on-Grade Thickness	8 in
-------------------------	------

Allow. Coefficient of Friction:	0.3	
(0.7) Earthquake :	3.9 kips	
Dead Load:	19 kips	Includes Slab-on-Grade Weight
Sliding Resistance:	5.66 kips	
Unity Check $U_c =$	1.46 > 1.0 OK	



Quantum Consulting Engineers LLC
1511 Third Avenue, Suite 323
Seattle, WA 98101

Project: Centeris Data Centers

Date: 2/2/24


Job No: 23444.01

Designer: TVM

Sheet: 3

Client: Benaroya

Checked:

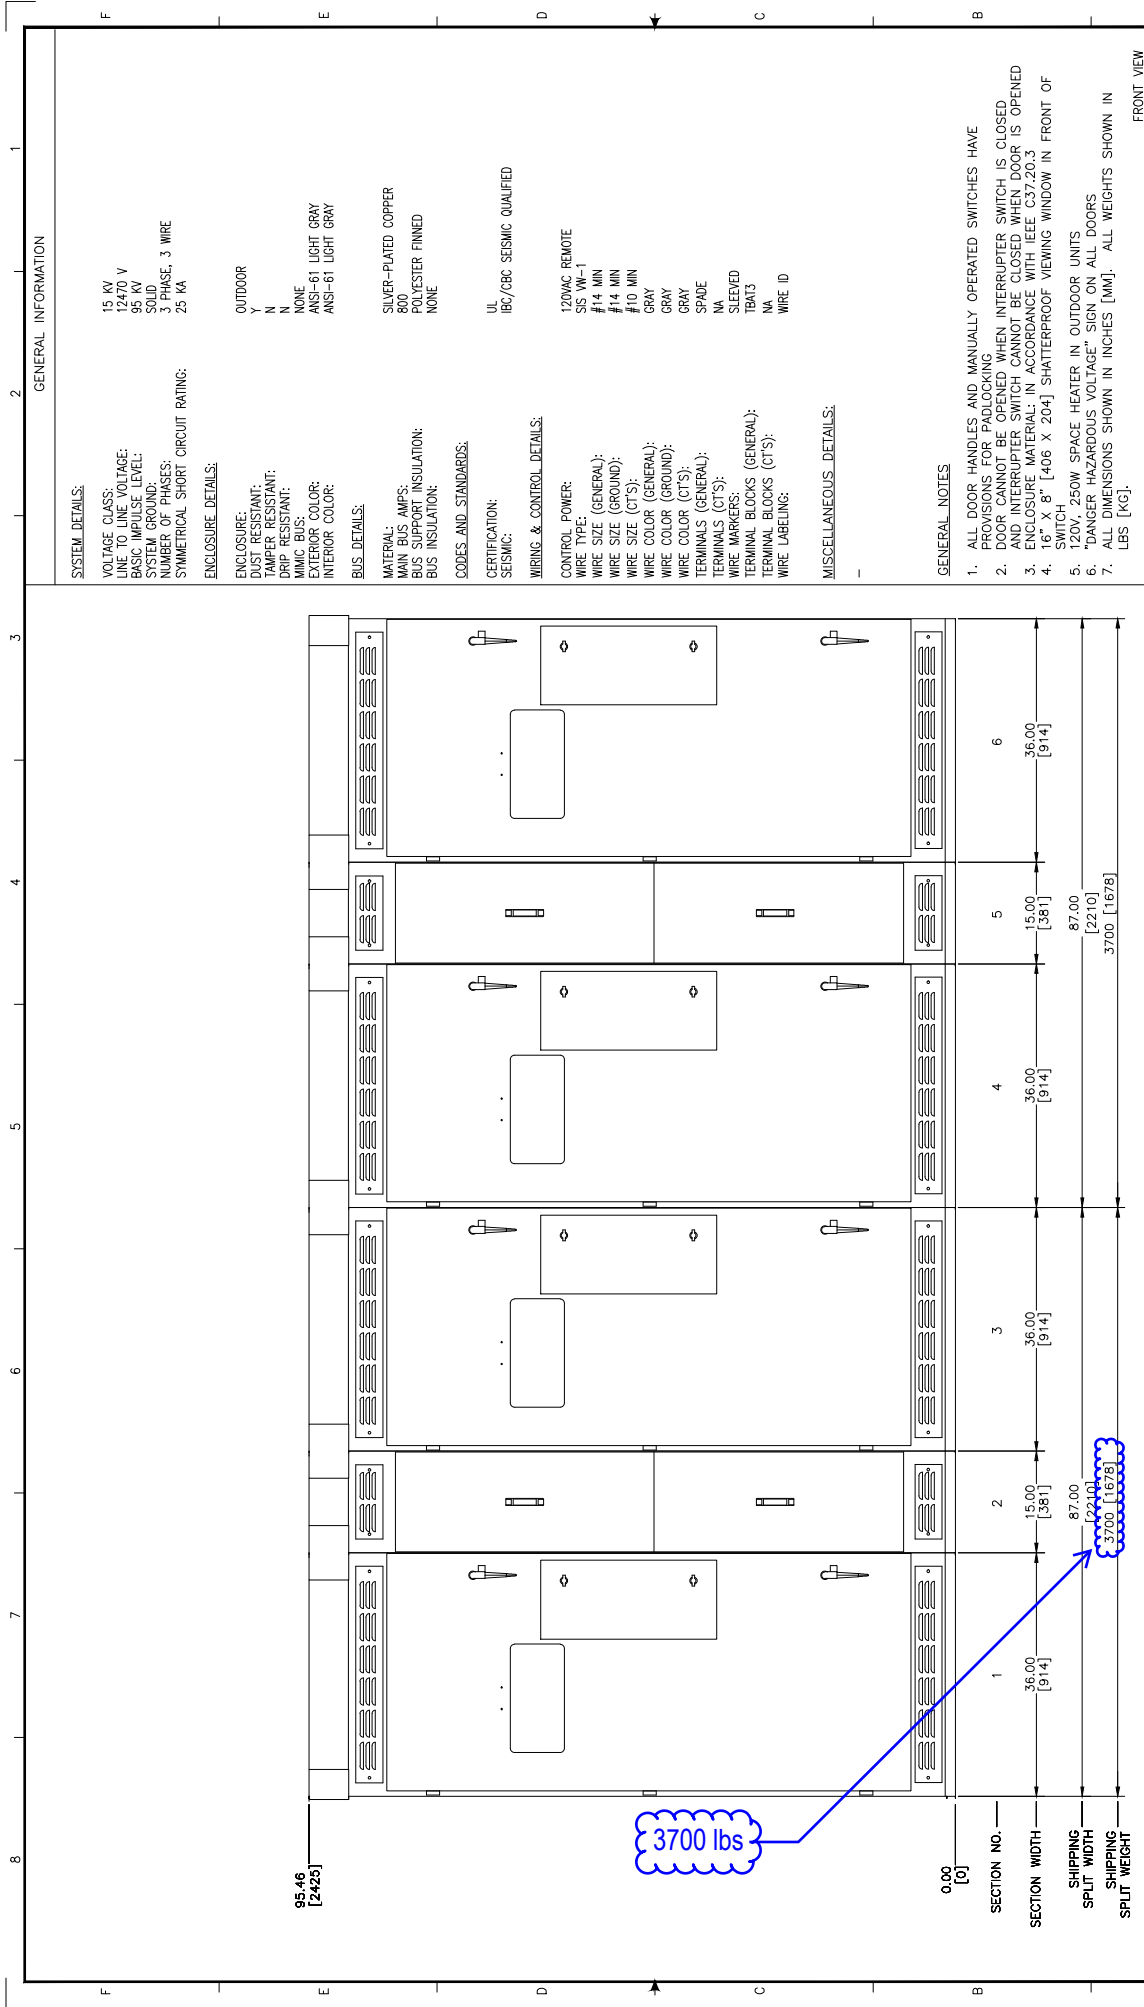

GENERAL INFORMATION

SYSTEM DETAILS:
 VOLTAGE CLASS: 15 KV
 LINE TO LINE VOLTAGE: 12470 V
 BASIC IMPULSE LEVEL: 95 KV
 SYSTEM GROUND: SOLID
 NUMBER OF PHASES: 3 PHASE, 3 WIRE
 SYMMETRICAL SHORT CIRCUIT RATING: 25 KA

ENCLOSURE DETAILS:
 ENCLOSURE: OUTDOOR
 VIBRATION RESISTANT: Y
 FIRE RESISTANT: N
 Drip RESISTANT: N
 MIMIC BUS: NONE
 EXTERIOR COLOR: ANSI-61 LIGHT GRAY
 INTERIOR COLOR: ANSI-61 LIGHT GRAY

BUS DETAILS:
 MATERIAL: SILVER-PLATED COPPER
 MAIN BUS AMPS: 800
 BUS SUPPORT INSULATION: POLYESTER FINNED
 BUS INSULATION: NONE

CODES AND STANDARDS:
 CERTIFICATION: UL
 SEISMIC: IBC/CBC SEISMIC QUALIFIED

WIRING & CONTROL DETAILS:
 CONTROL POWER: 120VAC REMOTE
 WIRE TYPE: SIS W-1
 WIRE SIZE (GENERAL): #14 MIN
 WIRE SIZE (GROUND): #14 MIN
 WIRE SIZE (CT'S): #10 MIN
 WIRE COLOR (GENERAL): GRAY
 WIRE COLOR (GROUND): GRAY
 WIRE COLOR (CT'S): GRAY
 TERMINALS (GENERAL): SPADE
 TERMINALS (CT'S): N/A
 WIRE MARKERS: SLEEVED
 TERMINAL BLOCKS (GENERAL): N/A
 TERMINAL BLOCKS (CT'S): N/A
 WIRE LABELING: WIRE ID

MISCELLANEOUS DETAILS:


GENERAL NOTES

- ALL DOOR HANDLES AND MANUALLY OPERATED SWITCHES HAVE PROVISIONS FOR PADLOCKING
- DOOR CANNOT BE OPENED WHEN INTERRUPTER SWITCH IS CLOSED
- AND INTERRUPTER SWITCH CANNOT BE CLOSED WHEN DOOR IS OPENED
- ENCLOSURE MATERIAL: IN ACCORDANCE WITH IEEE C37.20.3
- 16" X 8" [406 X 204] SHATTERPROOF VIEWING WINDOW IN FRONT OF SWITCH
- 120V, 250W SPACE HEATER IN OUTDOOR UNITS
- "DANGER HAZARDOUS VOLTAGE" SIGN ON ALL DOORS
- ALL DIMENSIONS SHOWN IN INCHES [MM]. ALL WEIGHTS SHOWN IN LBS [KG].

FRONT VIEW

<p>Issued for Construction The information on this document is suitable for use in establishing final installation and construction details. CASE NO. 311756454</p>		<p>DATE: COLTRANE CONNER 01/03/2024 APP: COLTRANE CONNER 01/03/2024 PRODUCT CODE: 3321 REVISION: 1</p>		<p>DATE: COLTRANE CONNER 01/03/2024 TITLE: CENTERS DATA CENTER - MWS TYPE: 1--MWSV S.O.: G23P10H MEDIUM VOLTAGE SWITCH DWG SIZE: LSE0035566-002</p>		<p>OUTLINES: G23P10H-0 SHEET: 001 COREFILE: R6</p>	
<p>THE INFORMATION ON THIS DOCUMENT WAS CREATED BY AUTOCAD. THE INFORMATION IS FOR THE USER'S REFERENCE ONLY. IT IS NOT TO BE USED FOR THE PURPOSE IN WHICH IT WAS SUPPLIED.</p>							

CEC 01/08/2024 SHOP RELEASE 1

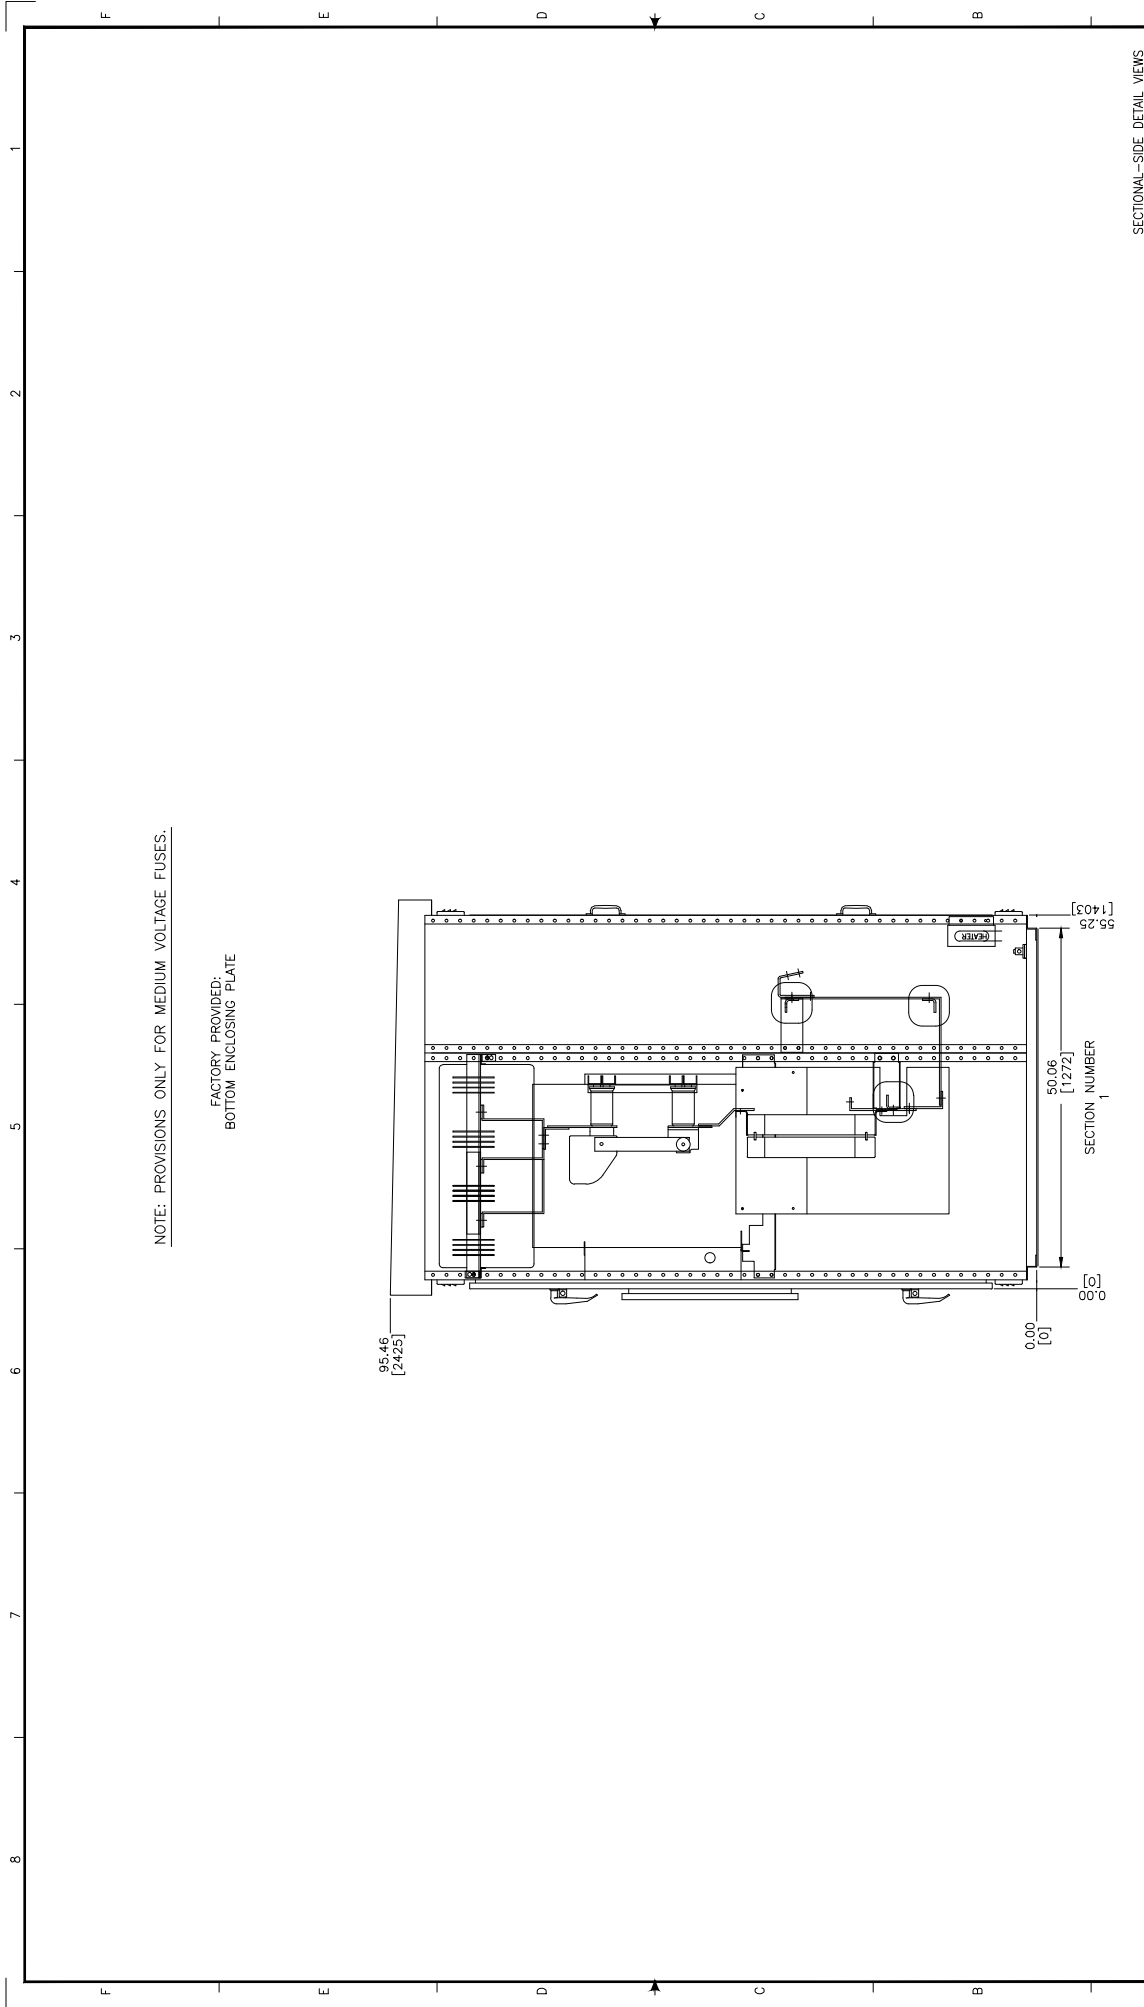

NOTE: PROVISIONS ONLY FOR MEDIUM VOLTAGE FUSES.

FACTORY PROVIDED:
BOTTOM ENCLOSING PLATE

SECTIONAL-SIDE DETAIL VIEWS

<p>Issued For Construction The information on this document is suitable for use in establishing final installation and construction details.</p> <p>CASE CODE: 341756454</p>		<p>DTR COLTRANE CONNER 01/03/2024</p> <p>APP COLTRANE CONNER 01/03/2024</p> <p>PRODUCT CODE 3321</p> <p>REVISION 1</p>	<p>DATE 01/03/2024</p> <p>DATE 01/03/2024</p> <p>S.O. G23P10H</p> <p>DWG SIZE</p>	<p>TITLE CENTERS DATA CENTER - MWS</p> <p>1--MWS</p> <p>TYPE MEDIUM VOLTAGE SWITCH</p> <p>DWG LSE0035566-002</p>	<p>SECTION VIEW G23P10H-V</p> <p>SHEET 001</p>
<p>THE INFORMATION ON THIS DOCUMENT WAS CREATED BY EATON TO BE USED FOR THE PURPOSE IN WHICH IT WAS SUPPLIED.</p>		<p>SECTION: COREFB1-R6</p>			

CEC 01/08/2024 SHOP RELEASE 1

Eaton 15 KV MV Switch Anchorage Design

IBC 2018, ASCE 7-16, ACI 318-14

1.) MV Switch

Weight: 7.4 kips
 Total Height H: 95.46 in
 Total Width B: 50.06 in
 Total Width L: 174 in
 Center of Gravity: 57.28 in
 Snow Load: 25 psf

2) Seismic Design per ASCE 7-16 Chapter 13 Non-Structural Components

Electrical Components

ap = 1
 Rp = 2.5
 Sds = 1.01
 Ie = 1.25

Lateral Loads

Lateral resistance is provided by the chiller anchored to the concrete slab.

Fp = 1.49 kips ASCE 7-16 EQ 13.3-1
 X Fpmin = 2.80 kips ASCE 7-16 EQ 13.3-2 Controls
 Fpmax = 14.95 kips ASCE 7-16 EQ 13.3-3

EQ = 2.80 kips

Shear Connection

Number of Anchors = 8.0
 Anchor Shear = $V \cdot \Omega / \#$ = 0.35 kips/anchor < Capacity = 4.5 kips OK
 1/2" Titan HD Anchors
 with 4 1/2" Embed

Overturning Resistance About Width

	C.O.G.	EQ	OT Moment
MV Switch	57.276 in	2.8 kips	13.4 k-ft
	Moment Arm	DL	Res. Moment
Resisting Dead Load	25.03 in	7.4 kips	15 k-ft
F.O.S. = M_R / M_{OT} =	1.2 OK		

Eaton 15 KV MV Switch Anchorage Design

IBC 2018, ASCE 7-16, ACI 318-14

3) Wind Design per ASCE 7-16 Chapter 29 Non-Building Structure Procedure

Wind Speed V:	104.0 mph	ASCE 7-16 Risk Category III
Exposure Cat.	B	
Exposure Coe Kz:	0.62	Table 26.10-1 (H = 20')
Direction Coe. Kd:	0.85	Table 26.6-1
Topo Coe. Kzt:	1.00	Sec. 26.8
V_Pressure qz =	14.6 psf	EQ 26.10-1
Gust Factor G:	0.85	Sec 26.11
Af =	115 sqft	
h/d =	1.91	
Cf =	1.30	Figure 29.4-1
F =	1.86 kips	EQ 29.4-1

Shear Connection

WL < EQ Shear Connection OK By Inspection

Overturing Resistance About Width

$M_{OT} = F \cdot H / 2$	7 k-ft
$M_R = DL \cdot W / 2$	15 k-ft
F.O.S. = $M_R / M_{OT} =$	2.1 OK



Quantum Consulting Engineers LLC
1511 Third Avenue, Suite 323
Seattle, WA 98101

Project: Centeris Data Centers

Date: 2/2/24

Job No: 23444.01


Designer: TVM

Sheet: 2





Client: Benaroya

Checked:

REAR VIEW

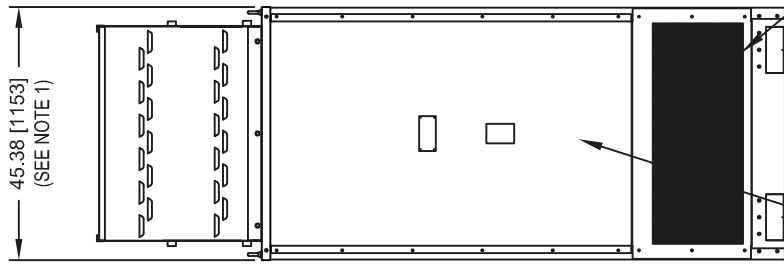

SIDE VIEW

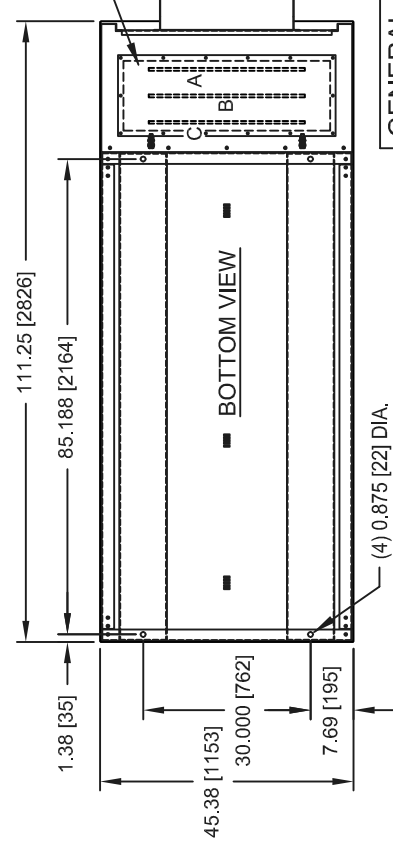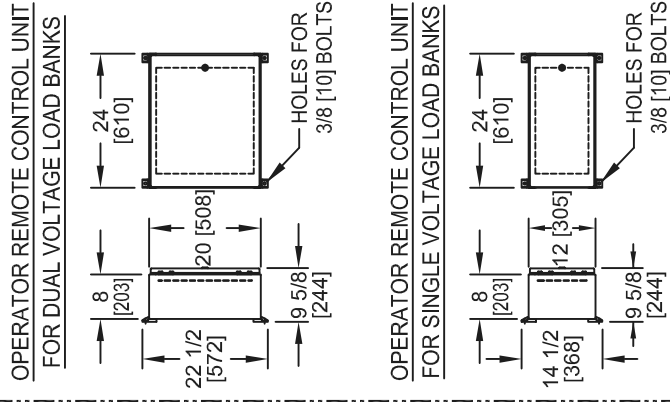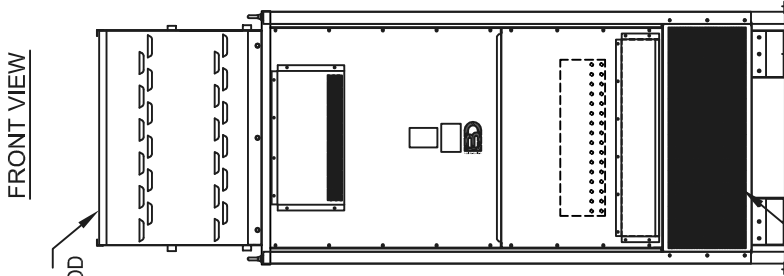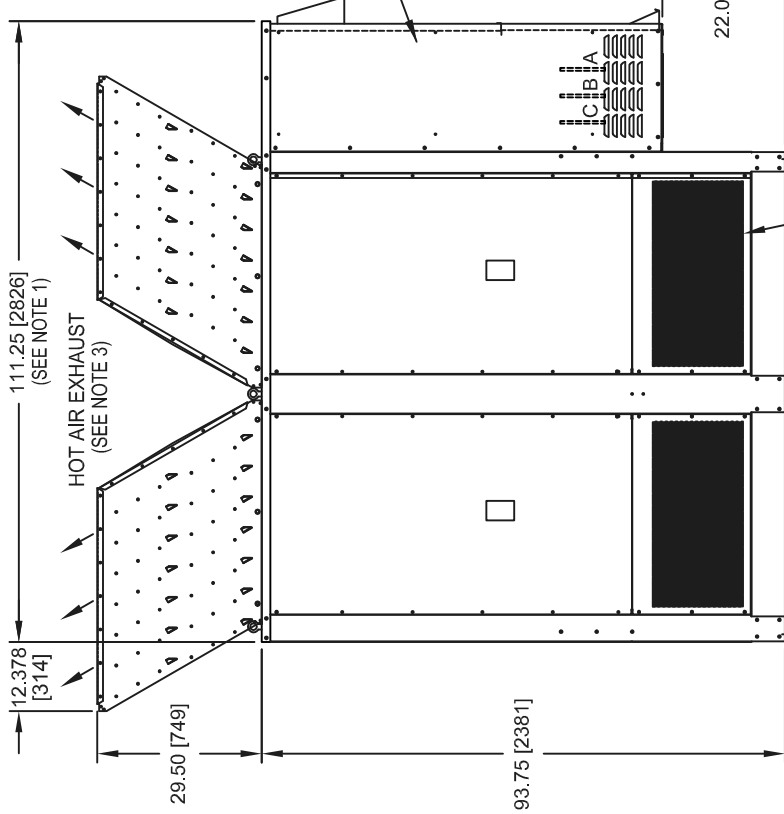

GENERAL NOTES:

- A. UNLESS OTHERWISE NOTED: 1. ALL DIMENSIONS ARE IN INCHES. EXCEPT "xxx]" = mm.
- B. APPROX WEIGHT: 4500 - 5000 LBS [2041-2268 KG].
- C. SEE ELECTRICAL SCHEMATIC FOR LOAD CAPACITY (KW) RATINGS, VOLTAGE RATINGS, AND BLOWER MOTOR RATING (H.P.)

RECOMMENDED MINIMUM CLEARANCES
(SEE O & M MANUAL FOR INSTALLATION DETAILS)

- NOTE 1) 36" [914] ALL 4 SIDES FOR MAINTENANCE.
- NOTE 2) 36"- 48" [914-1219] ALL 4 SIDES FOR AIR INTAKE.
- NOTE 3) 12'-4 FT [3658-4267] FOR TOP HOT AIR EXHAUST.
- NOTE 4) LOAD BANK IS SUPPLIED WITH OUTDOOR WEATHERPROOF NEMA-3R-TYPE ENCLOSURE.

LB Load Banks Direct
www.LoadBanksDirect.com

TEST LOAD BANK, 2000 THRU 3000KW, 36" FAN (WITH CHIMNEY HOOD)

DWG. NO. LS2000-3000-OL REV. -

CHECKED BY JJJ DATE 10/11/18

DRAWN BY MMP

1 of 1 SHEET

31 SIZE

THIS DRAWING IS PROPERTY OF LOAD BANKS DIRECT AND SHALL REMAIN SO WHILE IN USER'S POSSESSION. THE TECHNOLOGY SHOWN HERE IS STRICTLY PROPRIETARY AND IS NOT TO BE DISCLOSED TO ANY 3RD PARTY WITHOUT LOAD BANKS DIRECT PRIOR CONSENT.

Load Bank Anchorage & Foundation Design

IBC 2018, ASCE 7-16, ACI 318-14

2.) Load Bank

Weight: 5.0 kips
 Total Height H: 93.75 in
 Total Width B: 43.38 in
 Total Width L: 111.25 in
 Center of Gravity: 62.5 in
 Snow Load: 25 psf

2) Seismic Design per ASCE 7-16 Chapter 13 Non-Structural Components

Electrical Components

ap = 1
 Rp = 2.5
 Sds = 1.01
 Ie = 1.25

Lateral Loads

Lateral resistance is provided by the Load Bank anchored to the concrete slab.

Fp = 1.01 kips ASCE 7-16 EQ 13.3-1
 X Fpmin = 1.89 kips ASCE 7-16 EQ 13.3-2 Controls
 Fpmax = 10.10 kips ASCE 7-16 EQ 13.3-3

EQ = 1.89 kips

Shear Connection

Number of Anchors = 2.0
 Anchor Shear = $V \cdot \Omega / \#$ = 0.95 kips/anchor < Capacity = 7.1 kips OK
 3/4" Titen HD Screw Anchors
 with 5 1/2" Embed

Overturning Resistance About Width

	C.O.G.	EQ	OT Moment
Load Bank	62.5 in	1.9 kips	9.86 k-ft

	Moment Arm	DL	Res. Moment
Resisting Dead Load	42 in	5.0 kips	18 k-ft

F.O.S. = M_R / M_{OT} = 1.8 OK

Load Bank Anchorage & Foundation Design

IBC 2018, ASCE 7-16, ACI 318-14

3) Wind Design per ASCE 7-16 Chapter 29 Non-Building Structure Procedure


Wind Speed V:	104.0 mph	ASCE 7-16 Risk Category III
Exposure Cat.	B	
Exposure Coe Kz:	0.62	Table 26.10-1 (H = 20')
Direction Coe. Kd:	0.85	Table 26.6-1
Topo Coe. Kzt:	1.00	Sec. 26.8
V_Pressure qz =	14.6 psf	EQ 26.10-1
Gust Factor G:	0.85	Sec 26.11
Af =	72 sqft	
h/d =	2.16	
Cf =	1.30	Figure 29.4-1
F =	1.17 kips	EQ 29.4-1

Shear Connection

WL < EQ Shear Connection OK By Inspection

Overturing Resistance About Width

$M_{OT} = F \cdot H / 2$	5 k-ft
$M_R = DL \cdot W / 2$	9 k-ft
F.O.S. = $M_R / M_{OT} =$	2.0 OK

	Quantum Consulting Engineers LLC 1511 Third Avenue, Suite 323 Seattle, WA 98101	Project: Centeris Data Centers	Date: 2/2/24	Job No: 23444.01
		Designer: TVM	Sheet: 2	
		Client: Benaroya	Checked:	

Load Bank Foundation Design

IBC 2018, ASCE 7-16, ACI 318-14

4) Foundation Design

Bearing Analysis

Allowable Bearing 2000 psf
 Footing Width: 6.0 ft
 Footing Length: 10.0 ft
 Thickened Edge Width: 1.0 ft


Dead Load: 5 kips
 Snow Load: 1.5 kips
 1.0DL+1.0SL Pressure: 203 psf < 2000 psf OK

Earthquake OT 10 k-ft
 Applied Pressure: 164 psf
 1.15DL+0.7EQ Pressure: 295 psf < 2000 psf * (4/3) OK

Sliding Analysis

Slab-on-Grade Thickness 8 in

Allow. Coefficient of Friction: 0.3
 (0.7) Earthquake : 1.3 kips
 Dead Load: 11 kips Includes Slab-on-Grade Weight
 Sliding Resistance: 3.30 kips
 Unity Check $U_c =$ 2.49 > 1.0 OK

 Quantum Consulting Engineers LLC 1511 Third Avenue, Suite 323 Seattle, WA 98101	Project: Centeris Data Centers	Date: 2/2/24	Job No: 23444.01
		Designer: TVM	Sheet: 3
	Client: Benaroya	Checked:	

SWITCHBOARD GENERAL NOTES:

ELECTRICAL CHARACTERISTICS:
 SYSTEM VOLTAGE: 480VAC, 60Hz, 3PH-3W
 SYSTEM INTERRUPT RATING: 85KAIC
 SYSTEM AMPERAGE: 4000A

BUS CHARACTERISTICS:
 SILVER PLATED COPPER CONSTRUCTION
 BRACING: 85KAIC
 PHASE BUS SIZE/MATERIAL: (4) .25x5" Cu PER PHASE
 GROUND BUS SIZE/MATERIAL: (1) .25x4" Cu GROUND BUS

ENCLOSURE DATA:
 LISTING: UL891 SWITCHBOARD
 TYPE 3R FREE STANDING
 EXTERIOR PAINT COLOR: ANS1 61
 ACCESSIBILITY: FRONT
 ENTRY: TOP
 BREAKERS: ABB
 UL NAMEPLATE MOUNTING TYPE: RIVETED

ESTIMATED SHIPPING WEIGHT:
 SECTION 1: 1750 lbs
 SECTION 2: 2200 lbs
 SECTION 3: 2200 lbs
 SECTION 4: 2200 lbs
 SECTION 5: 2000 lbs
 SECTION 6: 1900 lbs
 COMPLETE LINEUP: 12250 lbs

WIRING:
 ALL WIRING TO BE SIS WIRE TYPE


PAGE TITLE: ENCLOSURE DETAILS		CUSTOMER: CERIO	
SHRD: 1-USS		PROJECT NO.:	
DRAWN BY		323	
CHECKED BY		DM	
APPROVED BY		SXT	
DRAWING		323-ED	
PAGE		01 OF 01	
<p>THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF MAVERICK POWER. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF MAVERICK POWER.</p>			
11/124	B1	REV FOR RELEASE - FLAT ROOF	SXT
12/13/23	B0	RELEASE	SXT
12/05/23	A1	RESUBMITTAL	DM
11/06/23	A0	SUBMITTAL	DM
DATE	REV	COMMENTS	DRAWN/CHECK/APPR.




MAVERICK POWER
 3381 E. PLANO PKWY., STE 175
 PLANO, TX 75074

LEGEND:


1. MANUAL MODE LIGHT
2. AUTO MODE LIGHT
3. MANUAL/AUTO CONTROL SWITCH
4. GENERATOR CONTROL SWITCH
5. SOURCE 1 AVAILABLE LIGHT
6. SOURCE 2 AVAILABLE LIGHT
7. WOODWARD ATS CONTROLLER
8. MAINTENANCE MODE SWITCH AND LIGHT
9. CIRCUIT BREAKER CLOSED
10. CIRCUIT BREAKER OPEN
11. CIRCUIT BREAKER TRIPPED
12. 83 LOCKOUT RELAY
13. CIRCUIT BREAKER CONTROL SWITCH
14. SURGE PROTECTION DEVICE
15. POWER METER VERIS ESX
16. IR VIEWING WINDOW
17. SPACE HEATER
18. RECTANGULAR IR VIEWING WINDOW

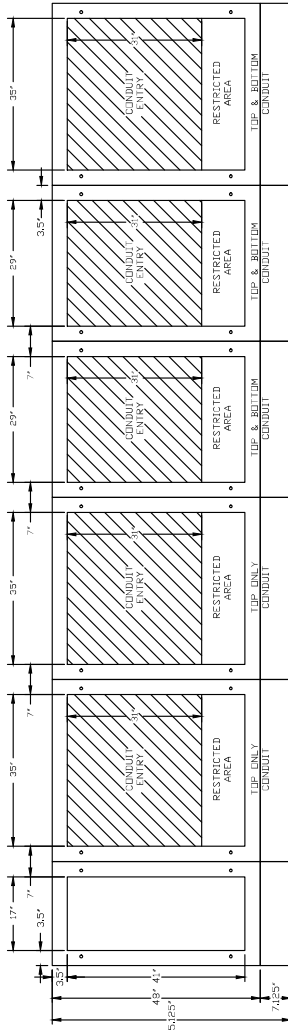


TOP VIEW

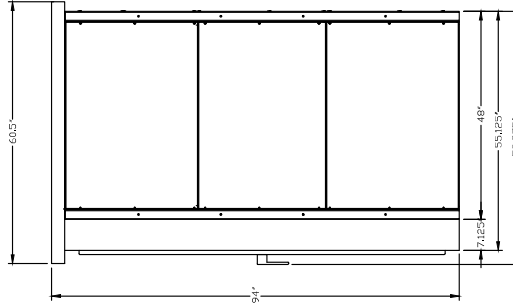

SIDE VIEW

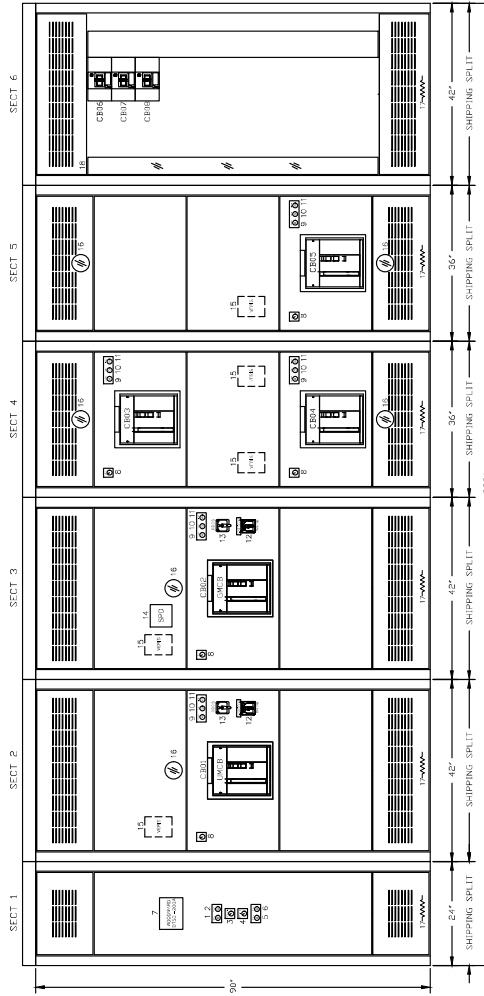

FRONT ELEVATION



CUSTOMER: CERIO
PROJECT NO.: 323

PAGE TITLE: ELEVATION
SHRD: 1-USS
DRAWN BY: DM
CHECKED BY: SXT
APPROVED BY: SXT
DRAWING: 323-EL
PAGE: 01 OF 01

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF MAVERICK POWER. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF MAVERICK POWER.

MP MAVERICK POWER

MAVERICK POWER
 3381 E. PLANO PKWY., STE 175
 PLANO, TX 75074

DATE	REV	COMMENTS	DRAWN	CHECK	APPR.
11/12/24	B1	REV FOR RELEASE - FLAT ROOF	SXT	SXT	SXT
12/13/23	B0	RELEASE	SXT	SXT	SXT
12/05/23	A1	RESUBMITTAL	DM	SXT	SXT
11/06/23	A0	SUBMITTAL	DM	SXT	SXT

4000A Switchgear Anchorage Design

IBC 2018, ASCE 7-16, ACI 318-14

1.) Switchgear

Weight: 2.2 kips
 Total Height H: 94 in
 Total Width B: 55.125 in
 Total Width L: 42 in
 Center of Gravity: 56.40 in
 Snow Load: 25 psf

2) Seismic Design per ASCE 7-16 Chapter 13 Non-Structural Components

Electrical Components

ap = 1
 Rp = 2.5
 Sds = 1.01
 Ie = 1.25

Lateral Loads

Lateral resistance is provided by the Switchgear anchored to the concrete slab.

Fp = 0.44 kips ASCE 7-16 EQ 13.3-1
 X Fpmin = 0.83 kips ASCE 7-16 EQ 13.3-2 Controls
 Fpmax = 4.44 kips ASCE 7-16 EQ 13.3-3

EQ = 0.83 kips

Shear Connection

Number of Anchors = 2.0
 Anchor Shear = $V \cdot \Omega / \#$ = 0.42 kips/anchor < Capacity = 4.5 kips OK
 1/2" Titan HD Anchors
 with 4 1/2" Embed

Overturning Resistance About Width

	C.O.G.	EQ	OT Moment
Switchgear	56.4 in	0.8 kips	3.92 k-ft
	Moment Arm	DL	Res. Moment
Resisting Dead Load	27.5625 in	2.2 kips	5 k-ft
F.O.S. = M_R / M_{OT} =	1.3 OK		

4000A Switchgear Anchorage Design

IBC 2018, ASCE 7-16, ACI 318-14

3) Wind Design per ASCE 7-16 Chapter 29 Non-Building Structure Procedure


Wind Speed V:	104.0 mph	ASCE 7-16 Risk Category III
Exposure Cat.	B	
Exposure Coe Kz:	0.62	Table 26.10-1 (H = 20')
Direction Coe. Kd:	0.85	Table 26.6-1
Topo Coe. Kzt:	1.00	Sec. 26.8
V_Pressure qz =	14.6 psf	EQ 26.10-1
Gust Factor G:	0.85	Sec 26.11
Af =	27 sqft	
h/d =	1.71	
Cf =	1.30	Figure 29.4-1
F =	0.44 kips	EQ 29.4-1

Shear Connection

WL < EQ Shear Connection OK By Inspection

Overturing Resistance About Width

$M_{OT} = F \cdot H / 2$	2 k-ft
$M_R = DL \cdot W / 2$	5 k-ft
F.O.S. = $M_R / M_{OT} =$	2.9 OK

	Quantum Consulting Engineers LLC 1511 Third Avenue, Suite 323 Seattle, WA 98101	Project: Centeris Data Centers	Date: 2/5/24	Job No: 23444.01
		Designer: TVM	Sheet: 2	
		Client: Benaroya	Checked:	