



720 3rd Avenue Suite 1500
Seattle Washington 98104-1878
(206) 667-0555

**MECHANICAL
DRAWINGS**


CENTERIS
VOLTAGE PARK UPS
1019 39th AVENUE SE
PUYALLUP, WA 98374

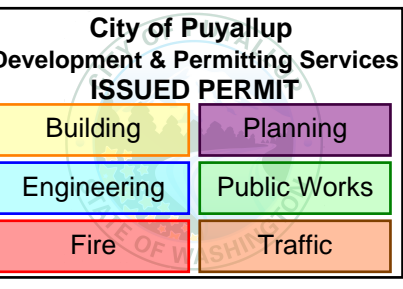

Revision No.	Description	Date
	PERMIT SET	2/2/2024
	DATA HALL PERMIT	2/16/2024
1	DATA HALL PERMIT REV 1	3/5/2024

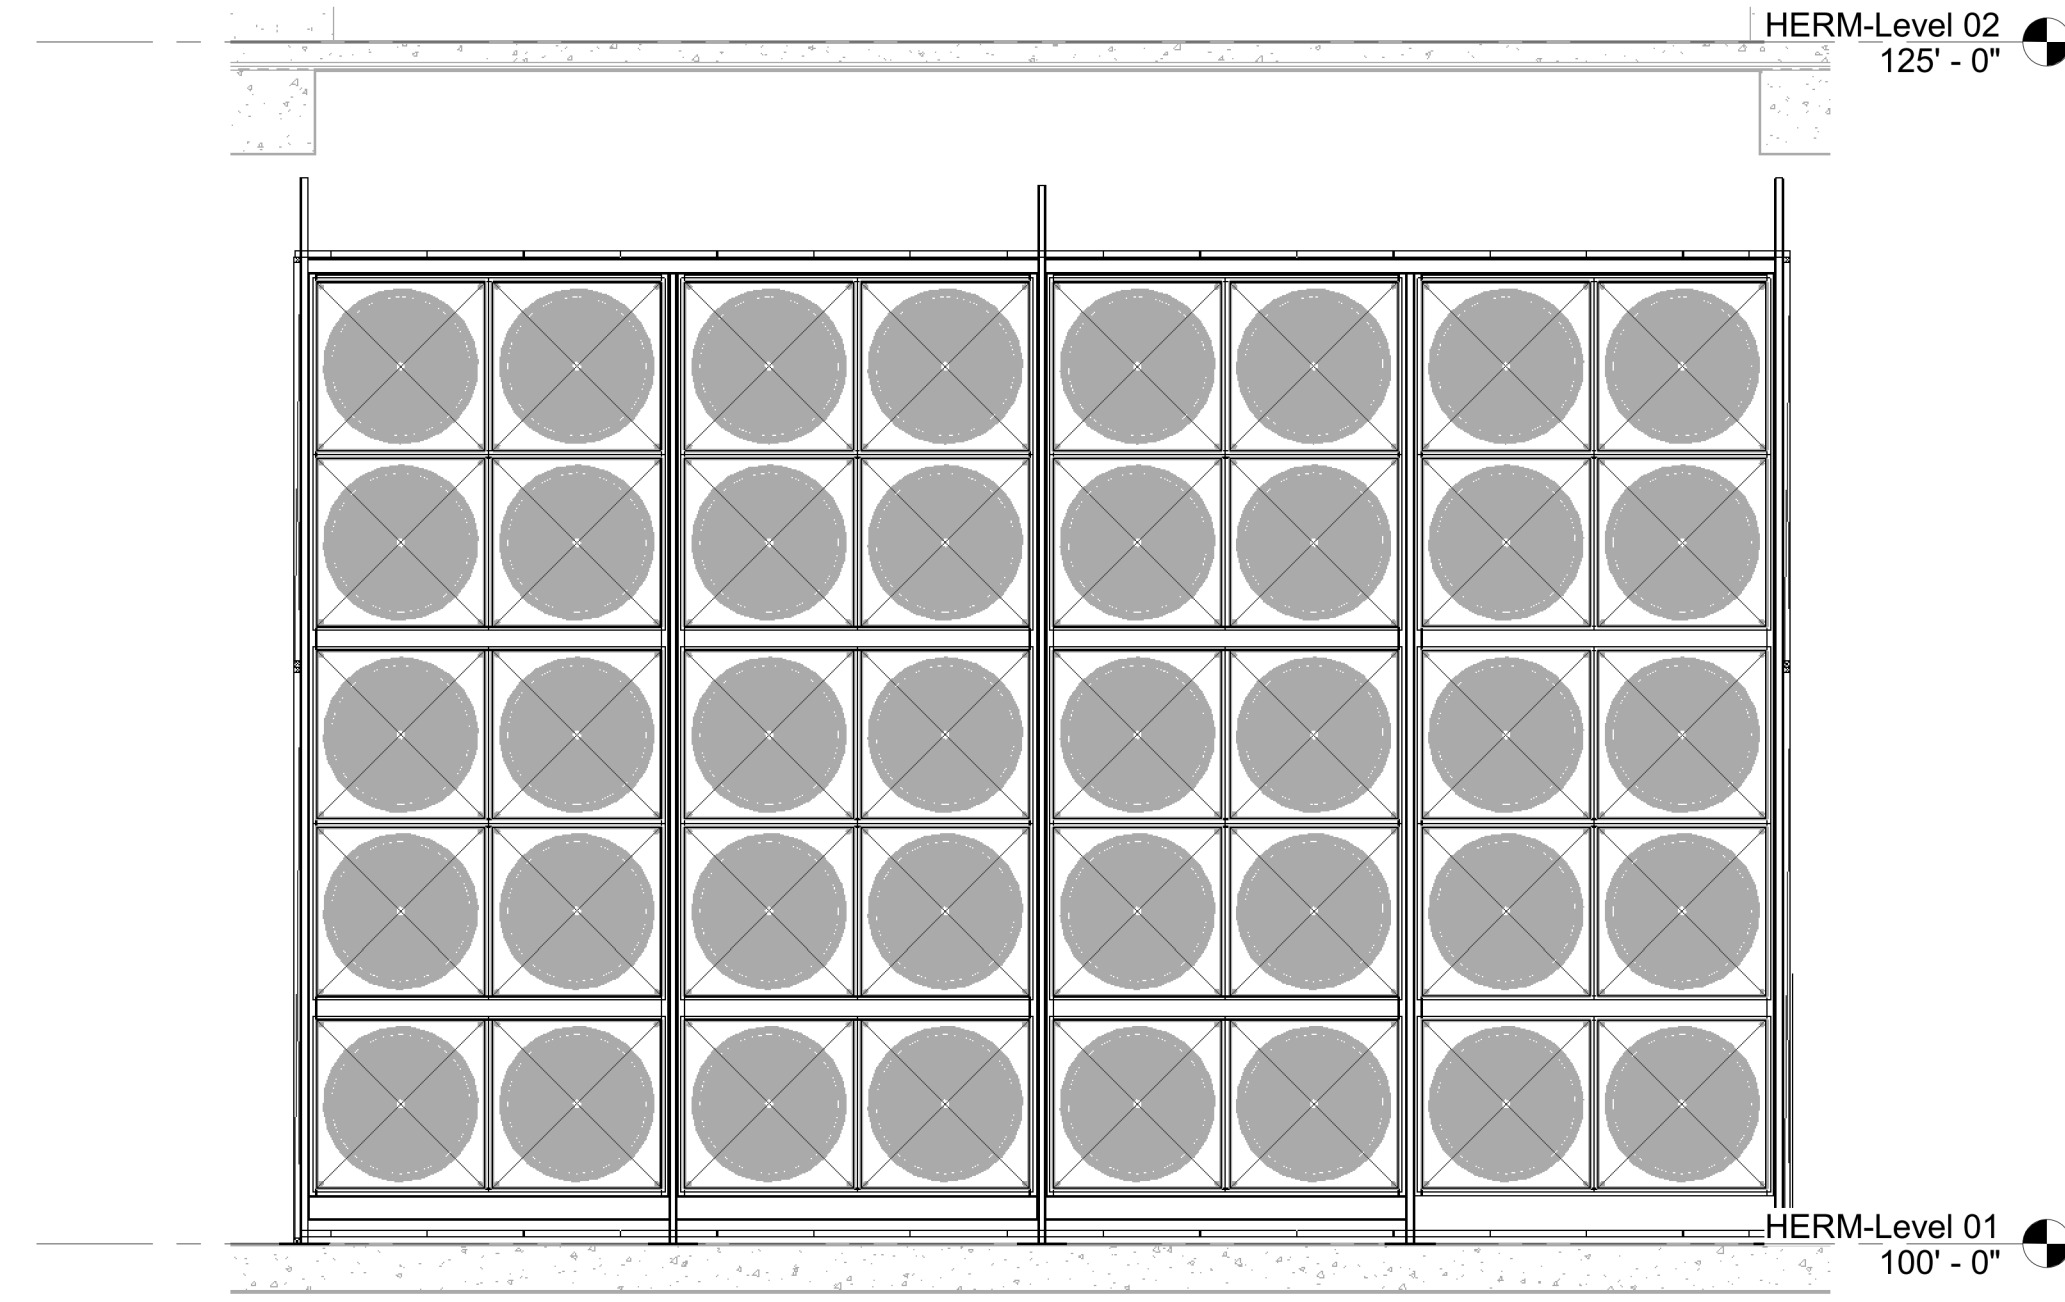


3 FANWALL DETAIL
M.VP.501 NTS

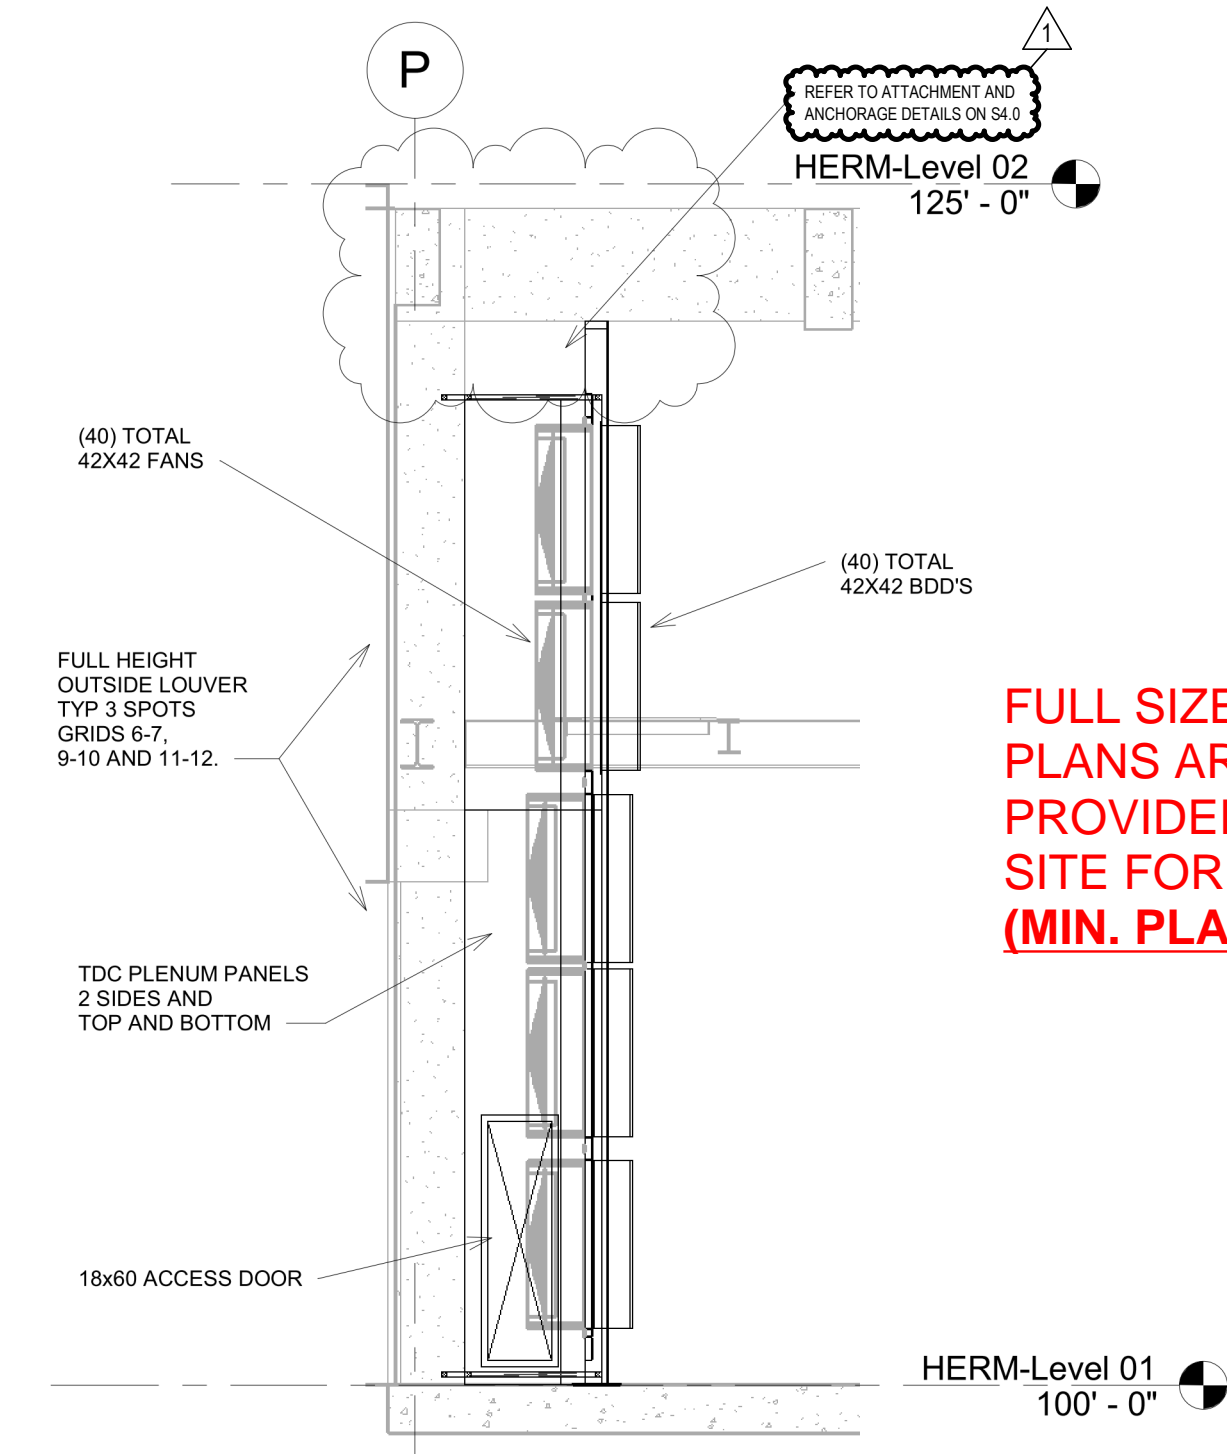

2 FANWALL SECTION
M.VP.501 NTS

**FULL SIZED LEDGIBLE COLOR
PLANS ARE REQUIRED TO BE
PROVIDED BY THE PERMITTEE ON
SITE FOR ALL INSPECTIONS
(MIN. PLAN SIZE 24" X 36")**

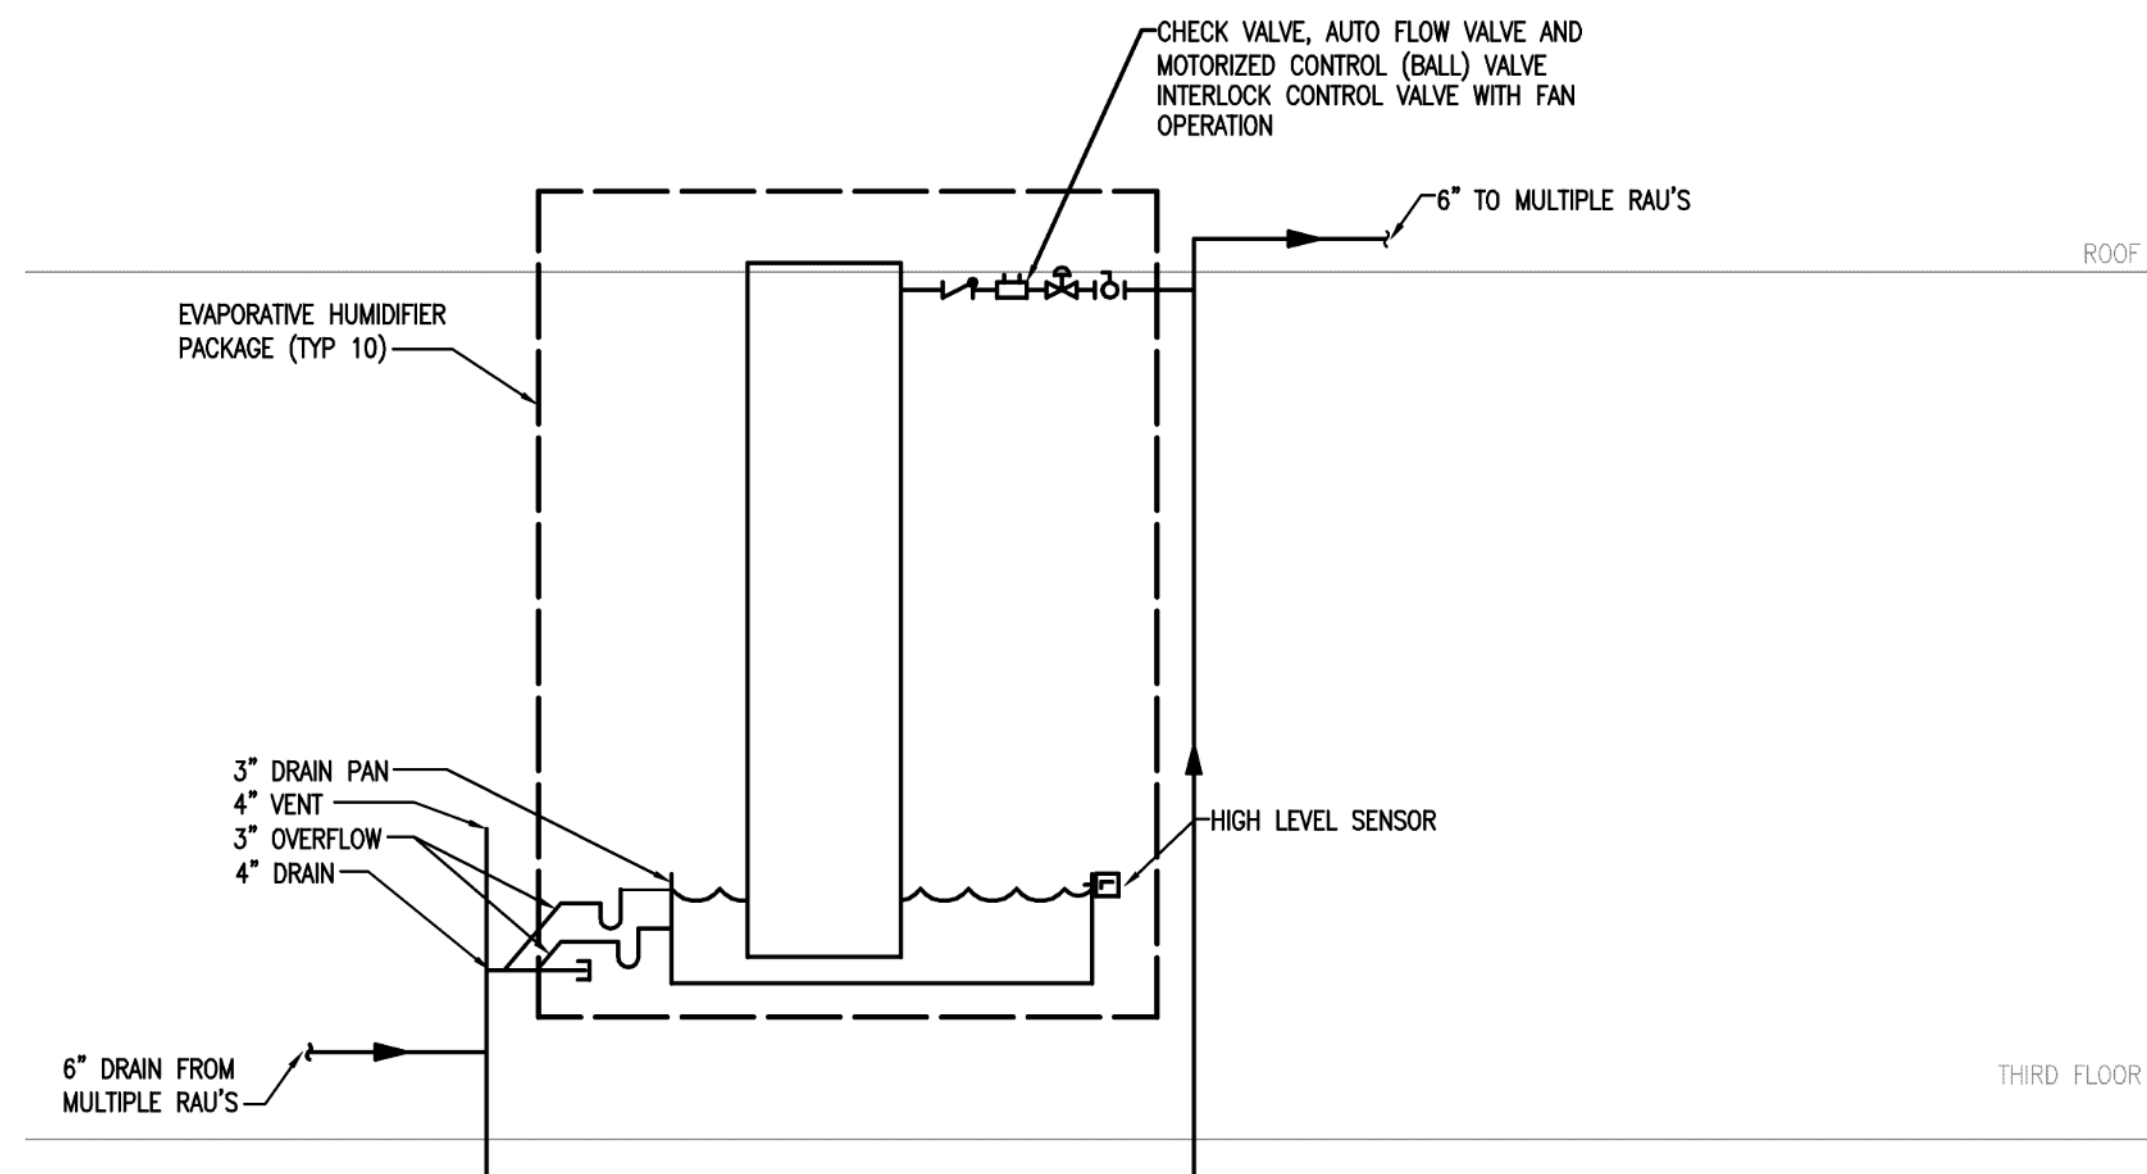

1 RAU PIPING CONNECTION DETAIL
M.VP.501 NTS

Drawn By: JLV Checked By: BO

**MECHANICAL
DETAILS**

M.VP.501

Sheet