

BASE LAYER 5/8" TYPE 'X' GYPSUM WALLBOARD OR GYPSUM

1-1/4" DRYWALL SCREWS 8" O.C., FACE LAYER 5/8" TYPE 'X'

AMERICAN GYPSUM CO. LLC, 5/8" FIREBLOC TYPE X GWB

24 x 36 - 1 1/2" = 1'-0"

12 x 18 - 3/4" = 1'-0"

SOUND TESTED WITH RESILIENT CHANNELS ON ONE SIDE AND 3-1/2" GLASS FIBER INSULATION IN STUD CAVITY ON BOTH SIDES.


2 HOUR SOUND WALL

VENEER BASE APPLIED PARALLEL TO EA. SIDE OF 2 x 4 WOOD

GYPSUM BOARD APPLIED PARALLEL TO EACH SIDE WITH 1-7/8"

JOISTS STAGGERED 24" O.C. ON OPPOSITE SIDES. HORIZONTAL

STUDS 16" O.C. STAGGERED 8" O.C. ON 2 x 6 WOOD PLATES WITH

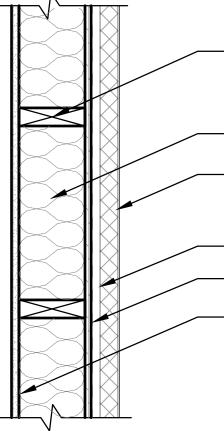

2X6 WOOD STUDS AT 16" O.C. USE TREATED SILL PLATES WHERE IN CONTACT WITH CONCRETE OR MASONRY

5

GA.FILE NO. WP5450

DRYWALL SCREWS 8" O.C.

BRACING REQUIRED AT MID HEIGHT.

PROPRIETARY GYPSUM BOARD:

- BATT INSULATION

- EXTERIOR INSULATION FINISH SYSTEM ON WEATHER BARRIER. INSTALL PER MANUFACTURER WRITTEN DIRECTION


· ADHESIVE

- EXTERIOR GRADE SHEATHING PER STRUCTURAL

— 1 LAYERS 5/8" TYPE 'X' GYPSUM WALL BOARD AT INTERIOR ON 6 MIL VAPOR BARRIER

TYPICAL EIFS WALL ASSEMBLIES

24 x 36 - 1 1/2" = 1'-0' 12 x 18 - 3/4'' = 1'-0''

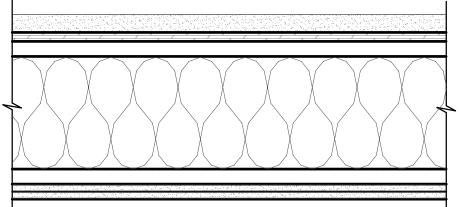

IBC TABLE 721,1,(3), ITEM NUMBER 21-1,1

24 × 36 - 1 1/2" = 1'-0"

12 x 18 - 3/4" = 1'-0"

FLOOR OR ROOF CONSTRUCTION 3/4" STRUCTURAL PANEL WITH EXT, GLUE APPLIED AT RIGHT ANGLES TO TOP OF JOIST WITH 8d NAILS


FLOOR JOIST FRAMING, SEE STRUCTURAL DRAWINGS FOR SIZES and spacing 5/8" TYPE X GWB APPLIED AT RIGHT ANGLES TO JOIST WITH 1-1/4" TYPE S

OR TYPE X GWB SCREWS 24" O.C. SECOND LAYER OF TYPE X GWB APPLIED AT RIGHT ANGLES TO JOIST WITH 1-7/8" TYPE S OR TYPE 2 DRYWALL SCREWS12" O.C. AT JOINTS AND

INTERMEDIATE JOIST. FACE LAYER TYPE G DRYWALL SCREWS PLACED 2" BACK ON EITHER SIDE OF FACE LAYER END JOINTS, 12" O.C.

12" GLASS FIBER INSULATION. ADD, 1 1/2" LIGHT WT. CONCRETE TOPPING ON STRUCTURAL PANEL

HOUR FLOOR-CLG

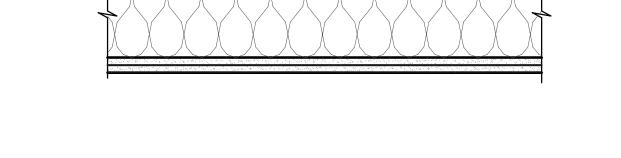

IBC TABLE 721.1.(3), ITEM NUMBER 21-1.1

В

FLOOR OR ROOF CONSTRUCTION 3/4" STRUCTURAL PANEL WITH EXT. GLUE APPLIED AT RIGHT ANGLES TO TOP OF JOIST WITH 8d NAILS


FLOOR JOIST FRAMING, SEE STRUCTURAL DRAWINGS FOR SIZES and spacing 5/8" TYPE X GWB APPLIED AT RIGHT ANGLES TO JOIST WITH 1-1/4"


TYPE S OR TYPE W DRYWALL SCREWS 24" O.C SECOND LAYER OF TYPE X GWB APPLIED AT RIGHT ANGLES TO JOIST WITH 1-7/8" TYPE S OR TYPE 2 DRYWALL SCREWS12" O.C. AT JOINTS AND INTERMEDIATE JOIST.

FACE LAYER TYPE G DRYWALL SCREWS PLACED 2" BACK ON EITHER SIDE OF FACE LAYER END JOINTS, 12" O.C.


7-1/4" GLASS FIBER INSULATION. ADD, 1 1/2" LIGHT WT. CONCRETE TOPPING ON STRUCTURAL PANEL




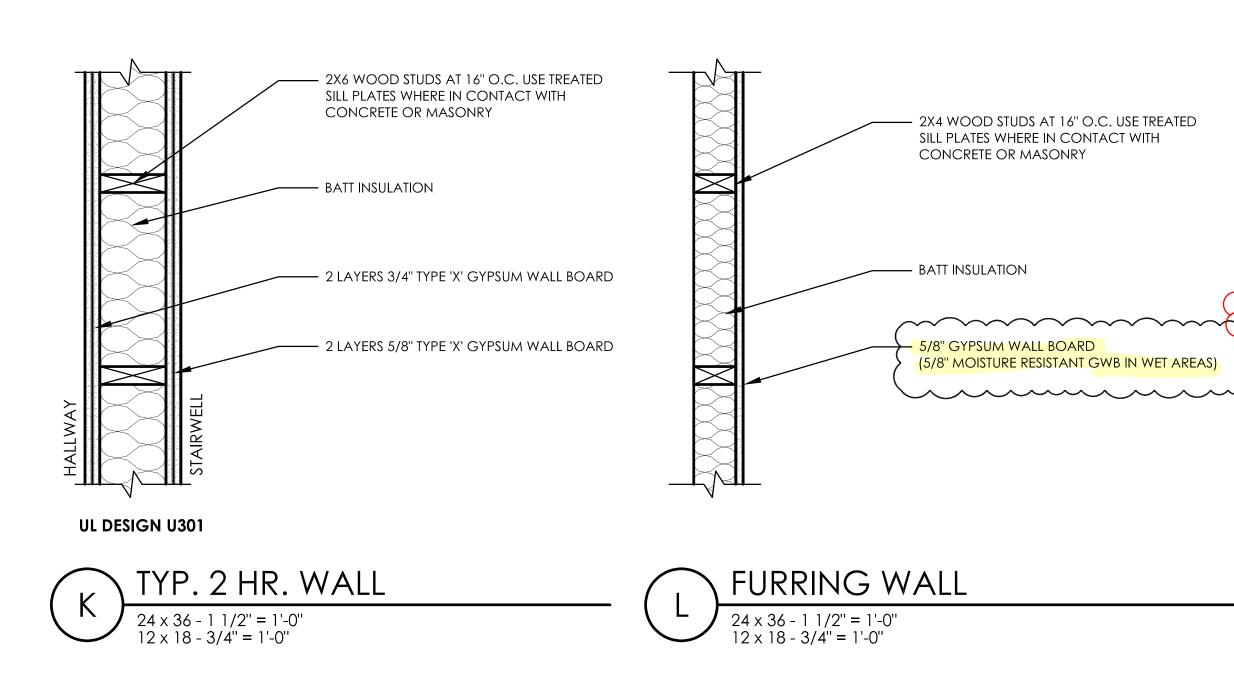


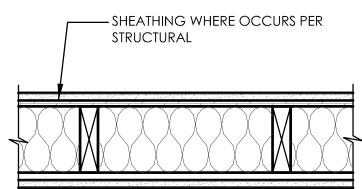



VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO CHANNELS WITH 1" TYPE 'S' DRYWALL SCREWS 6" O.C. AT HORIZONTAL JOINTS AND 12" O.C. AT INTERMEDIATE CHANNELS SPACE.




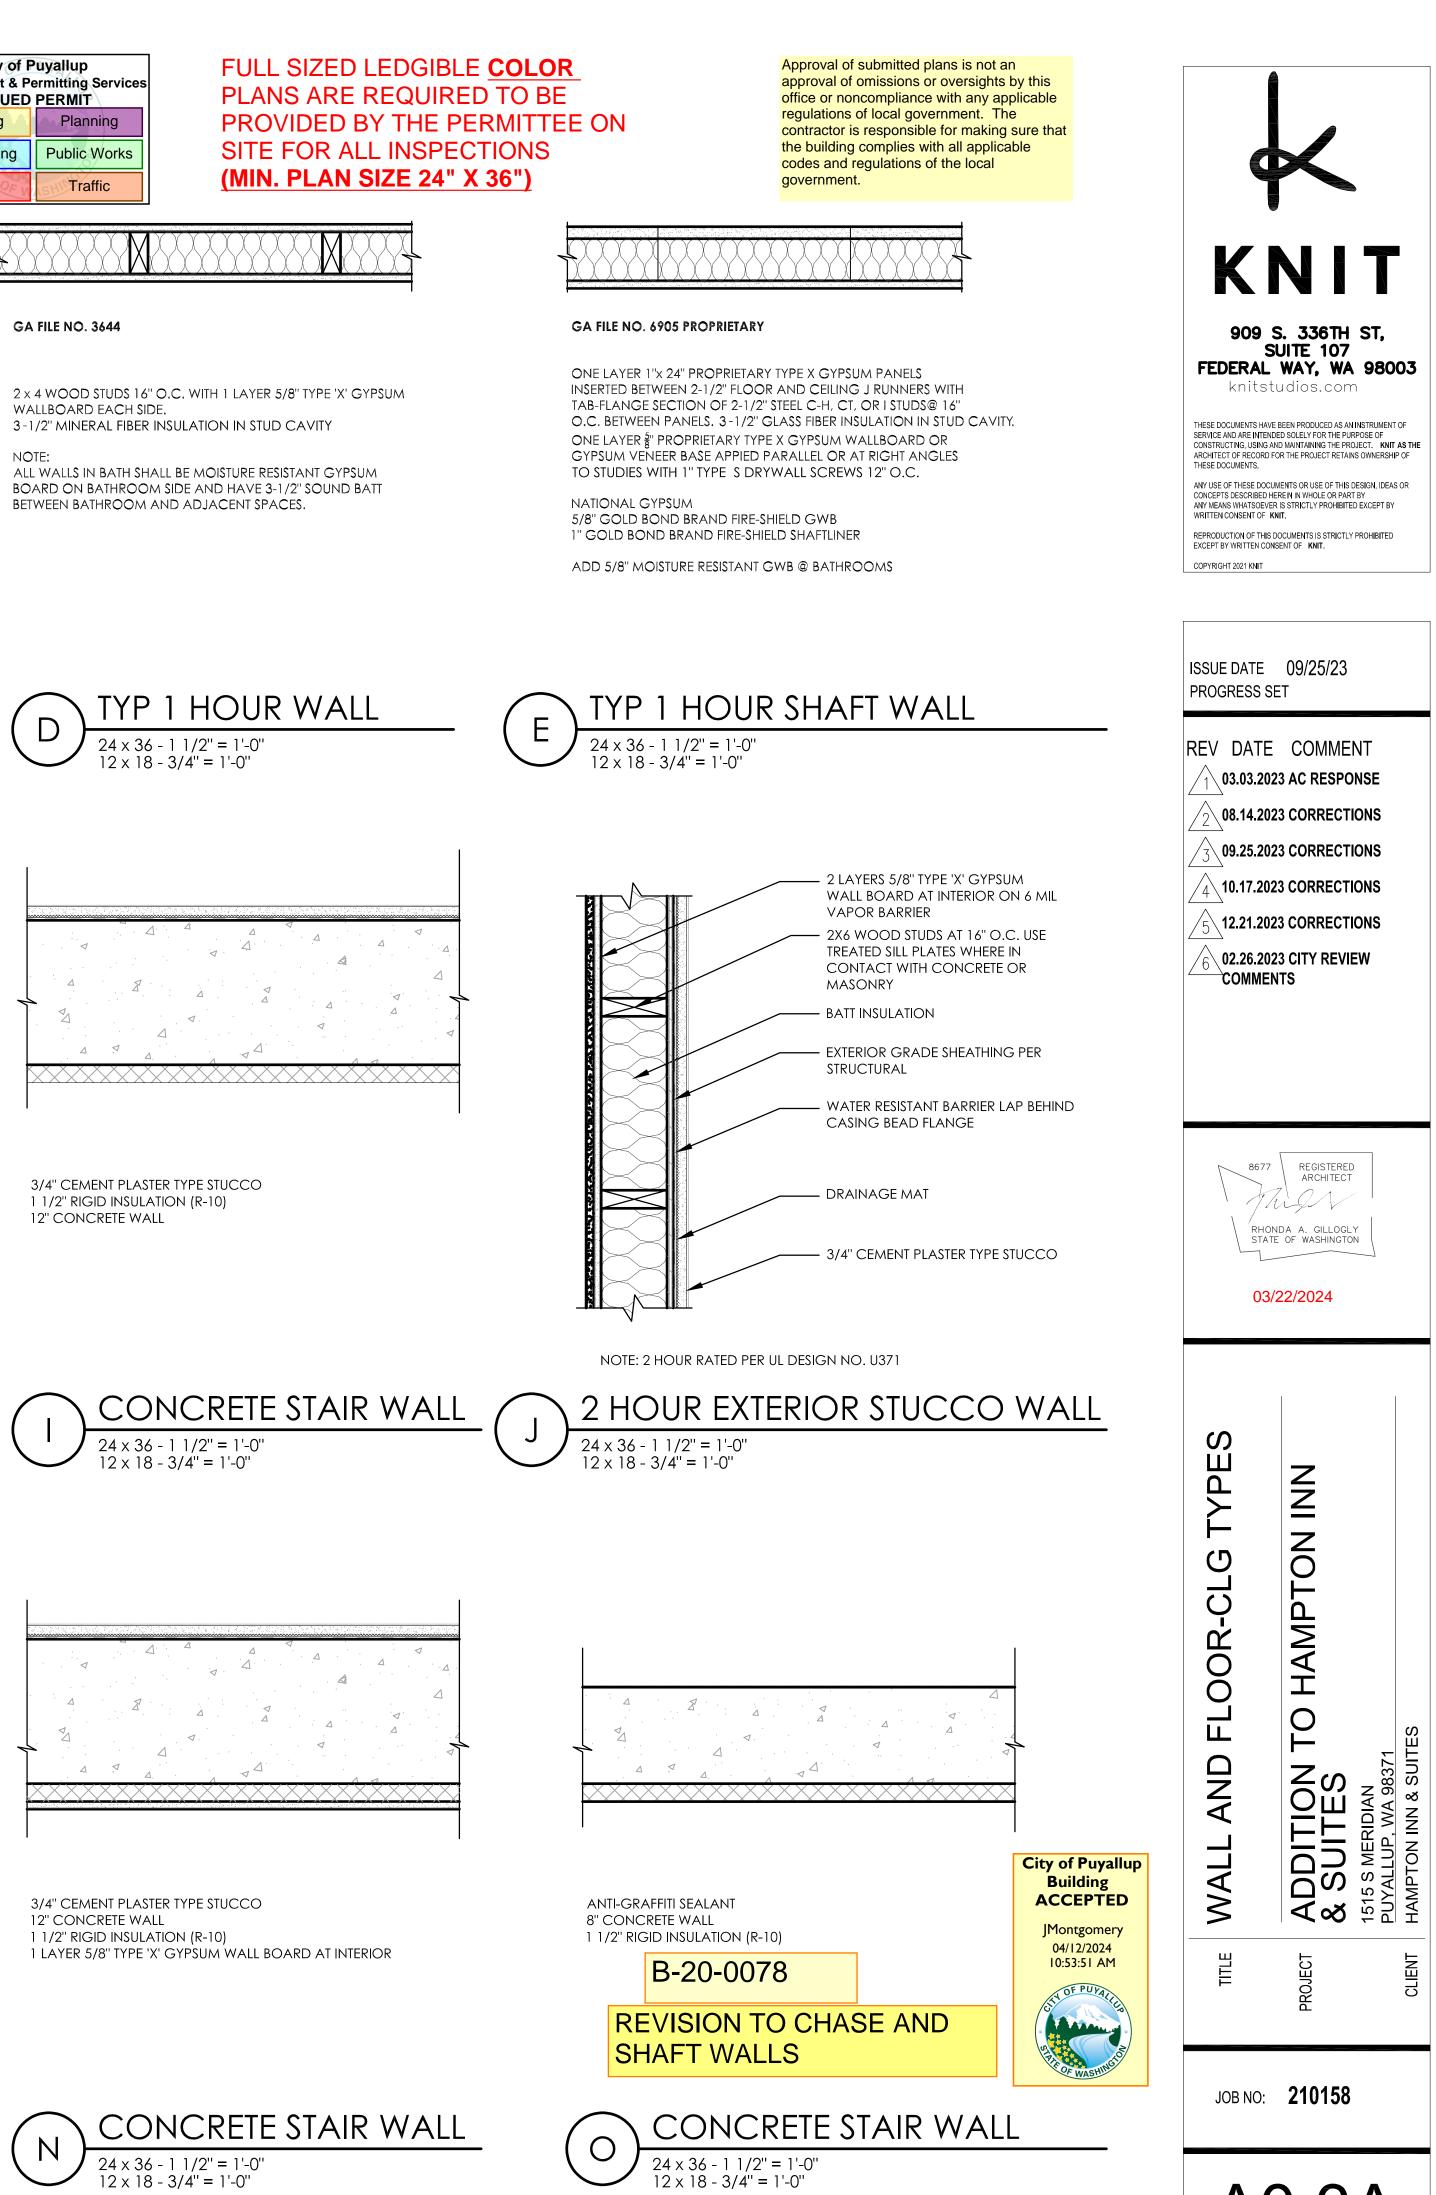


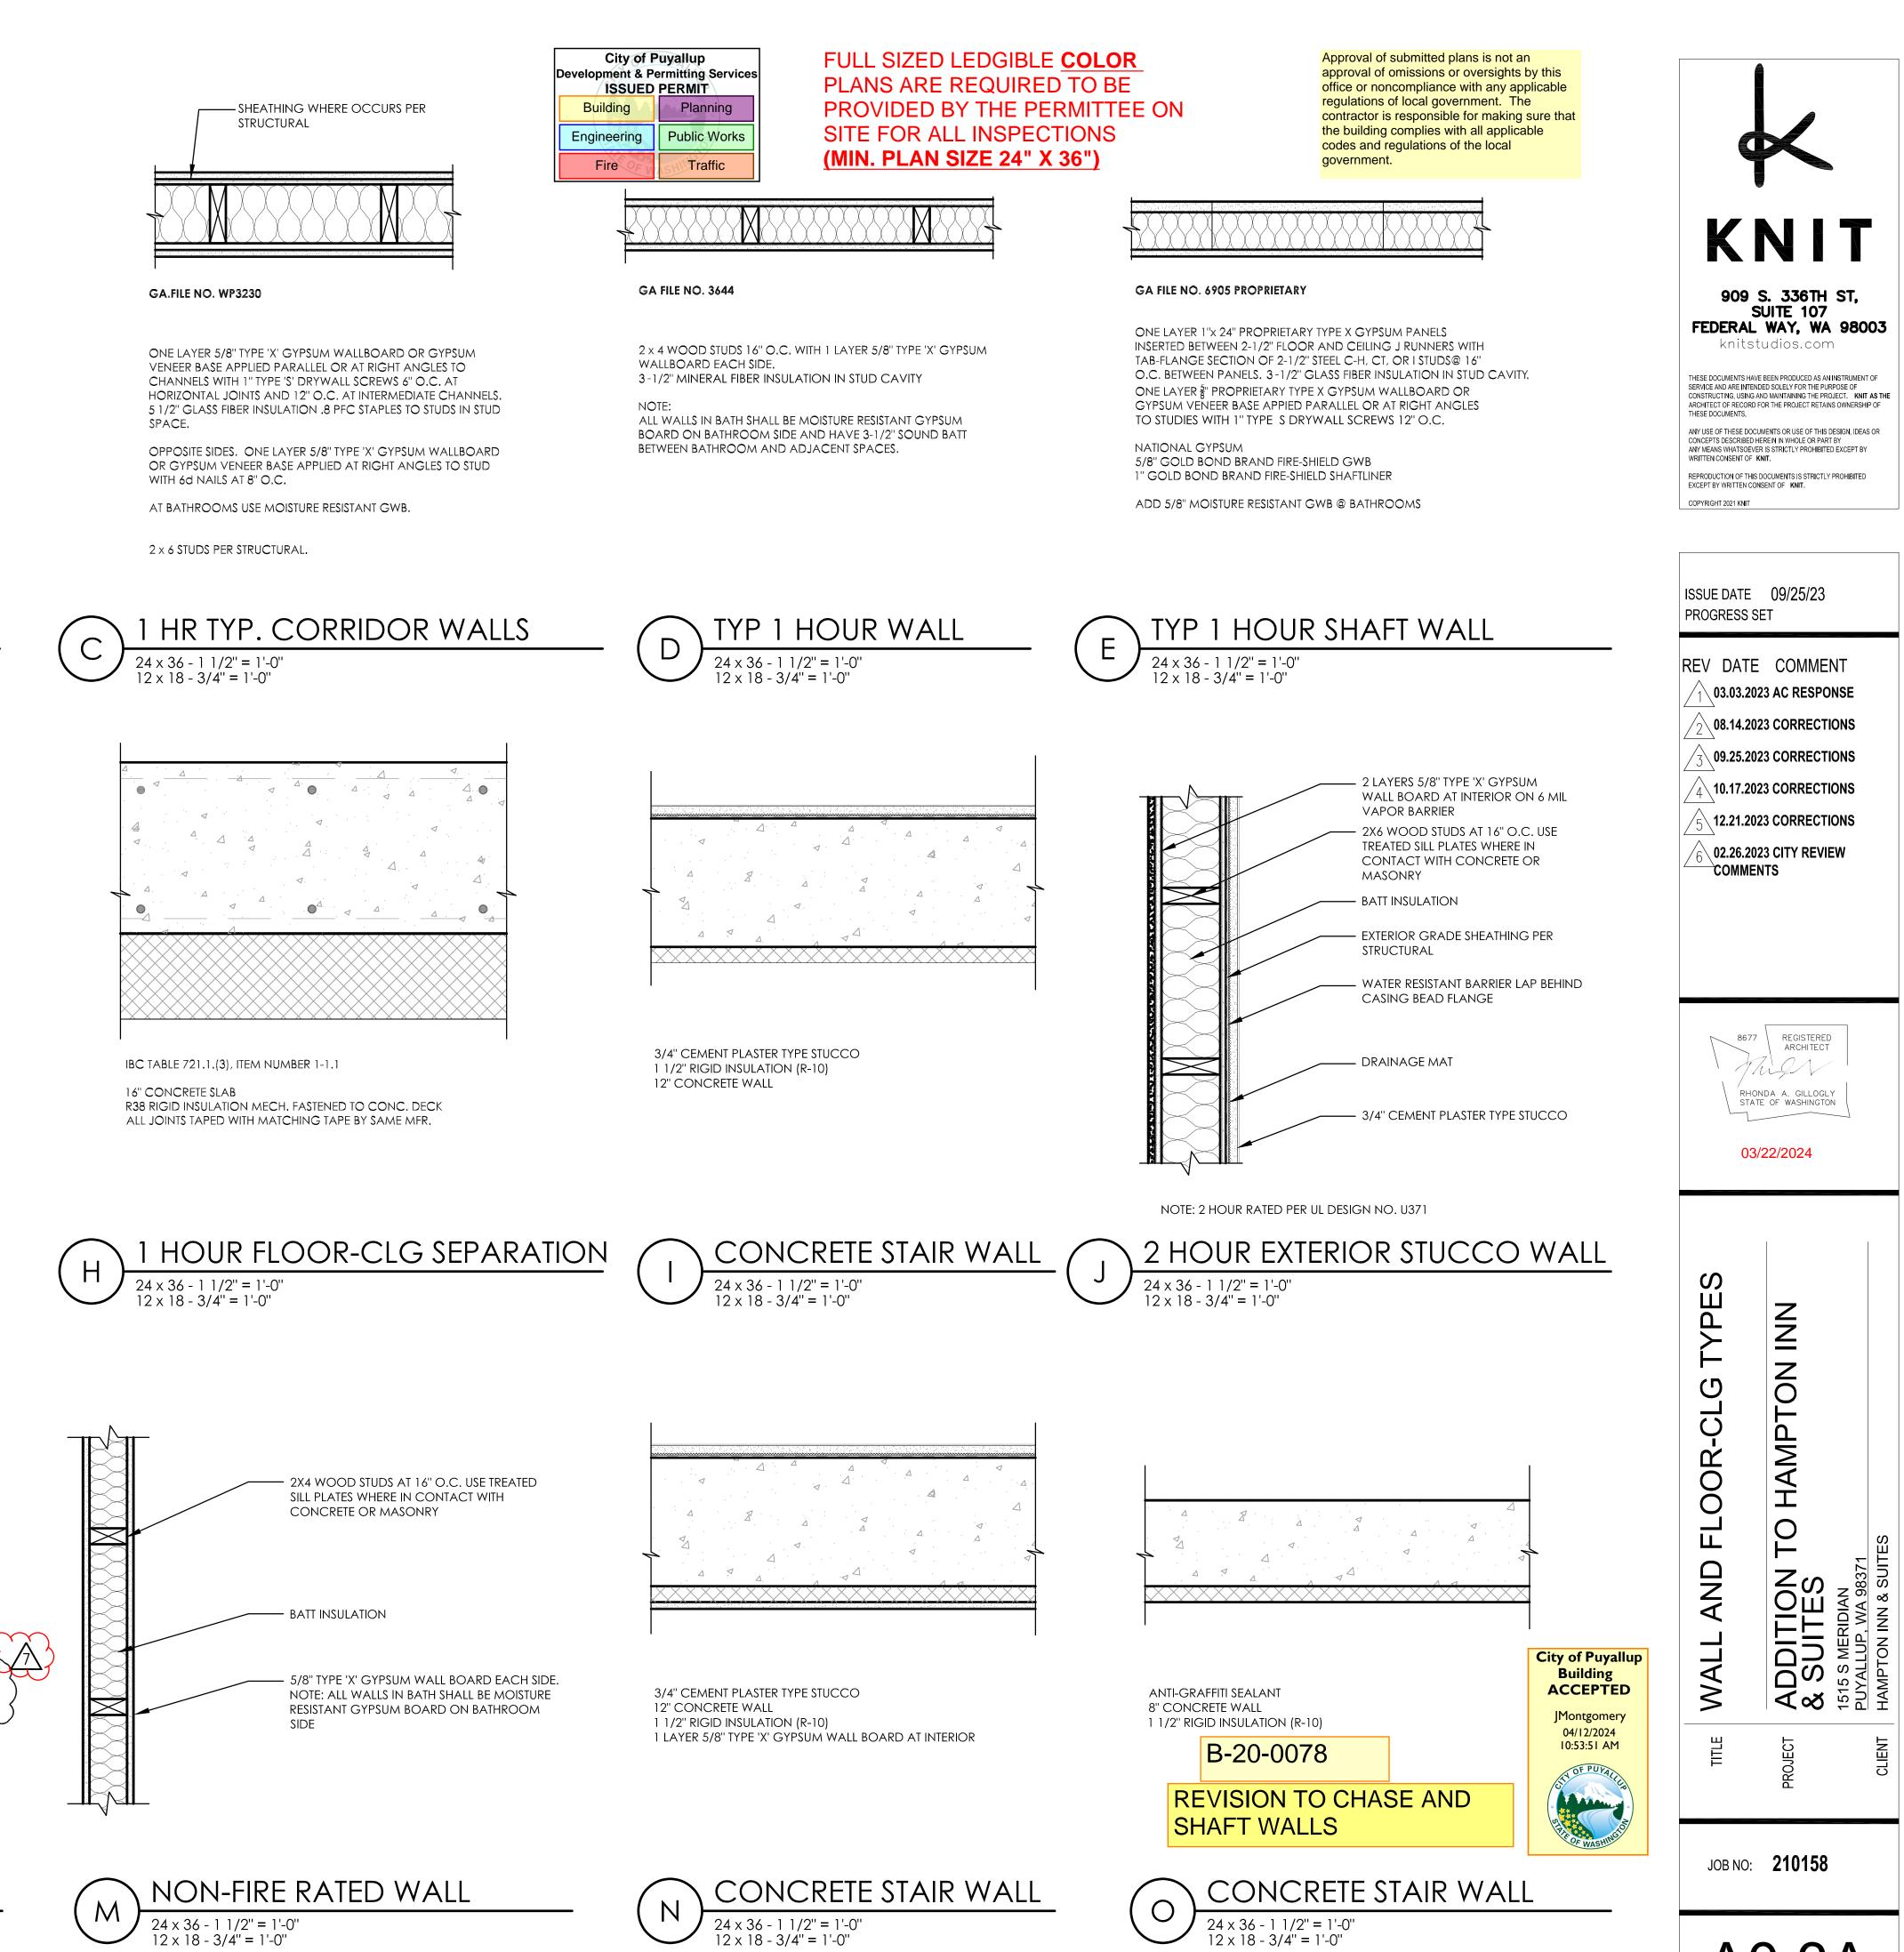

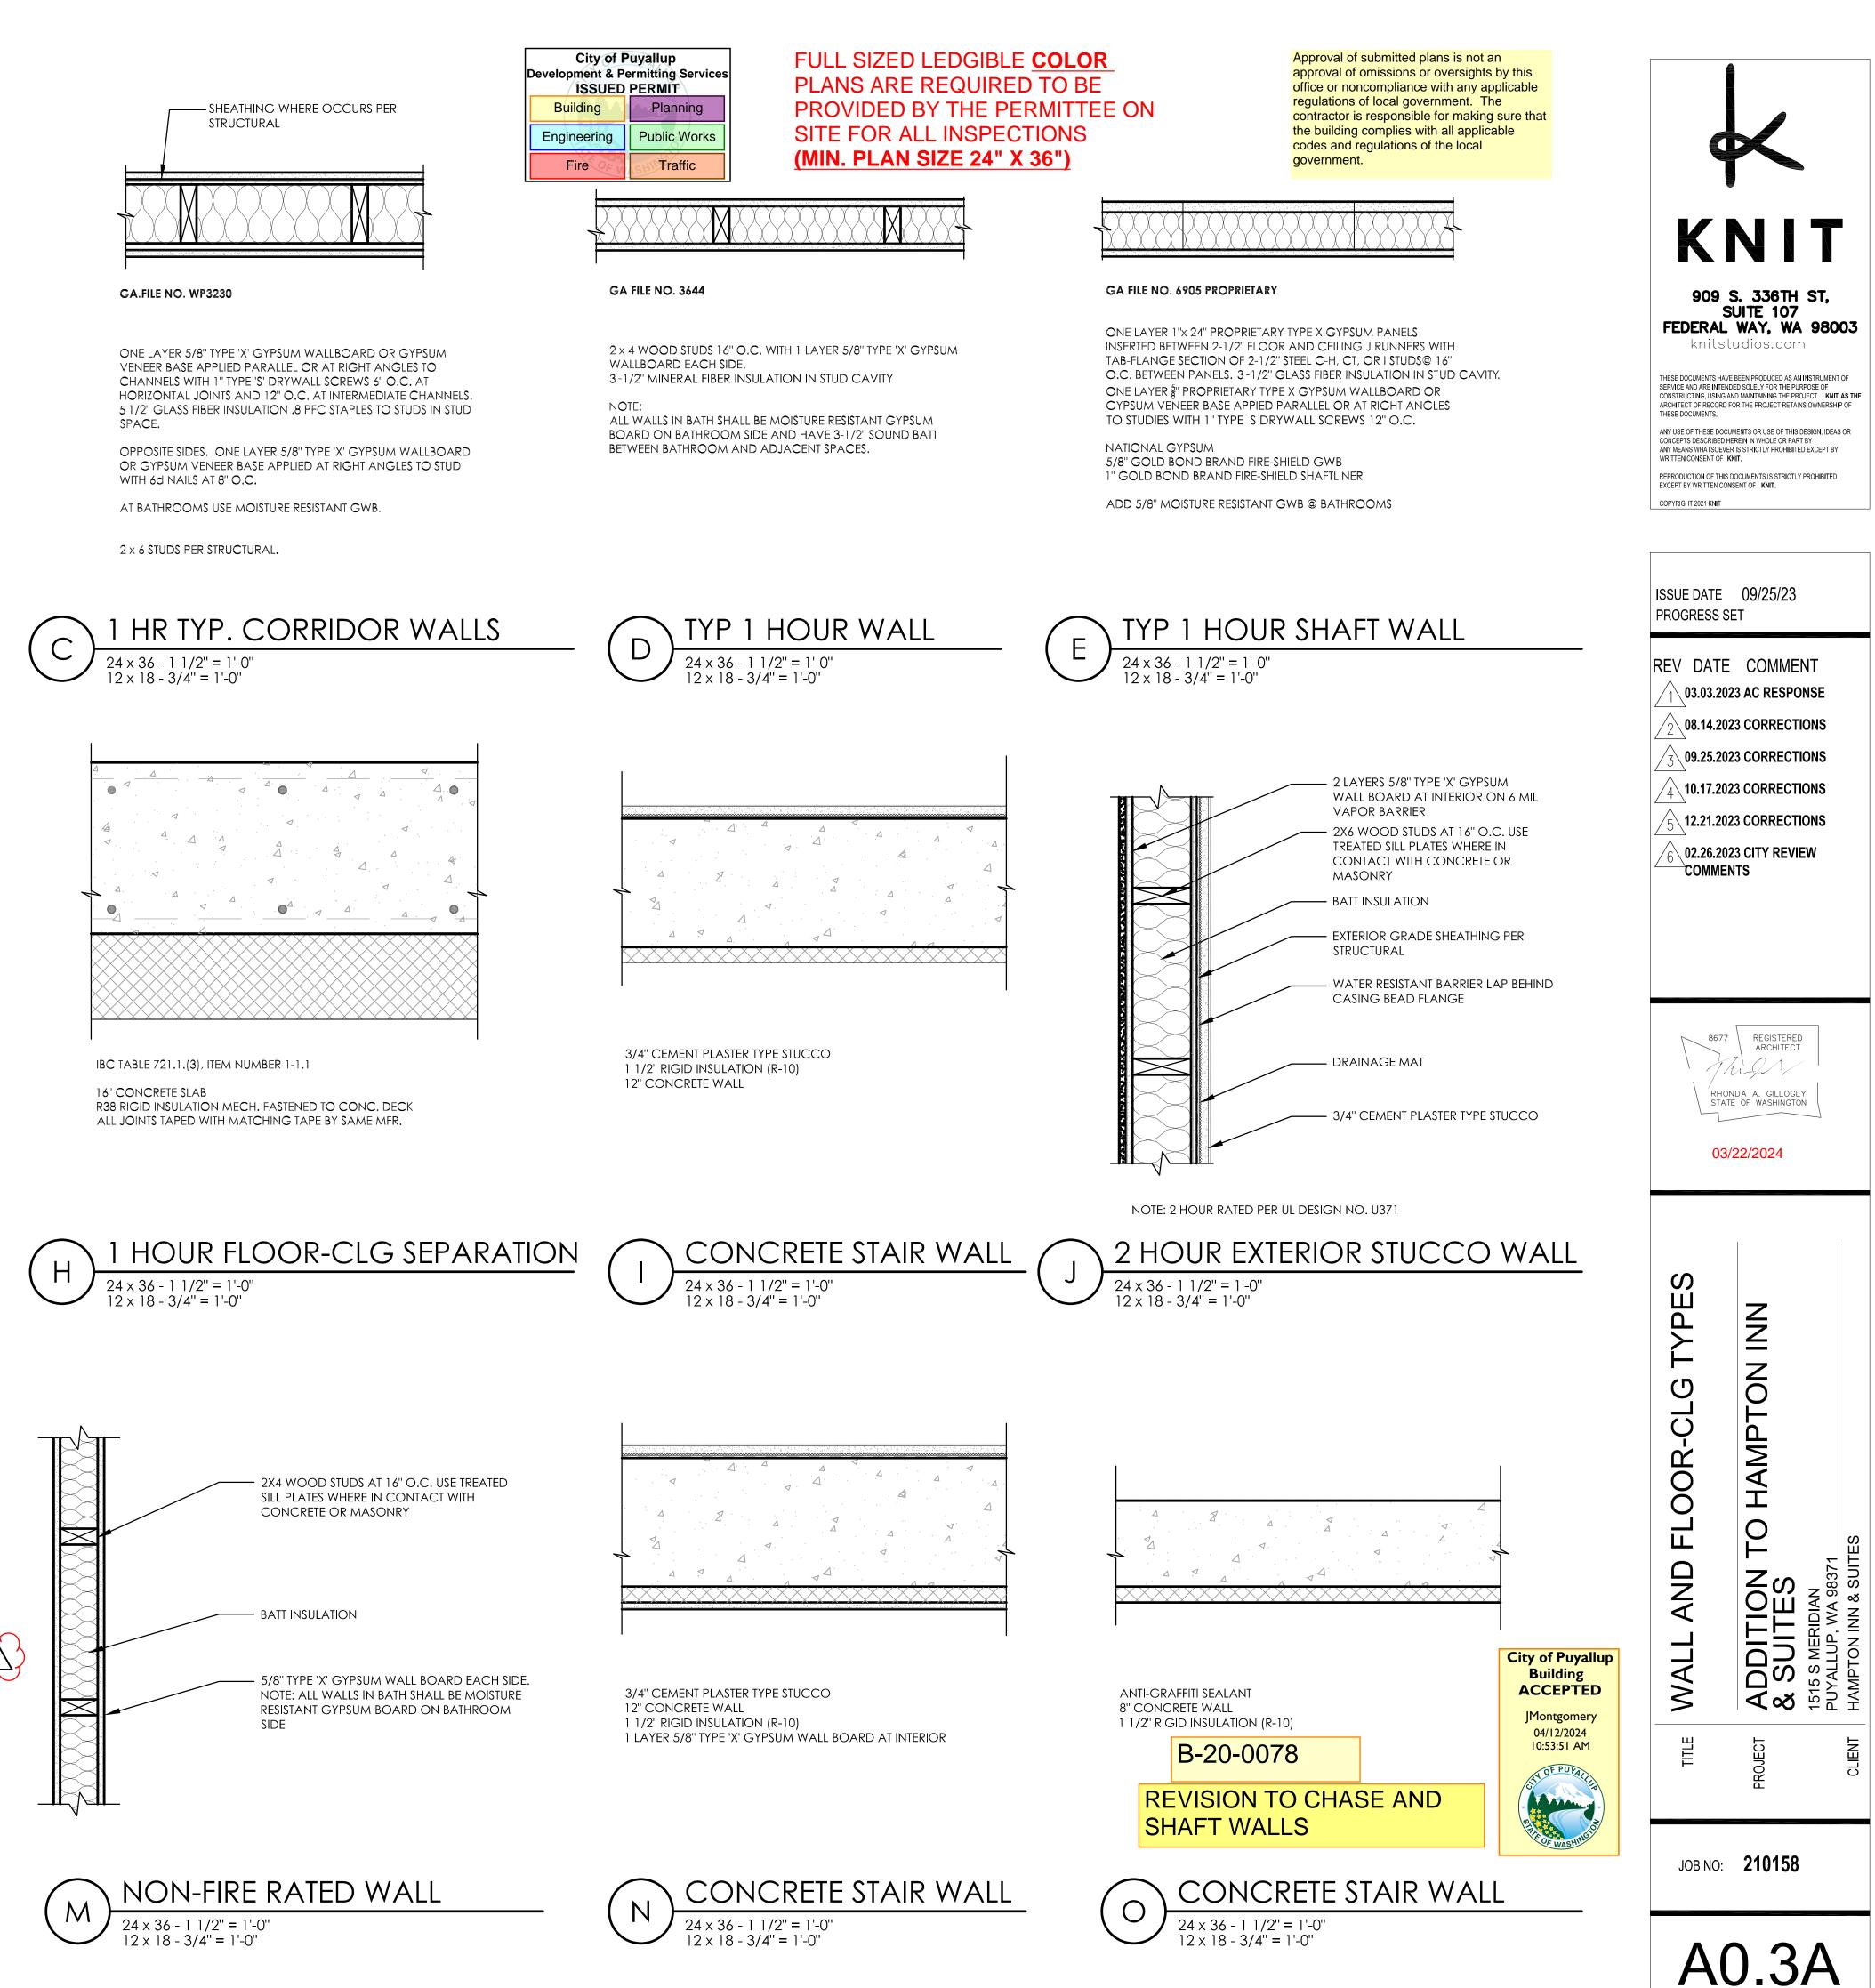

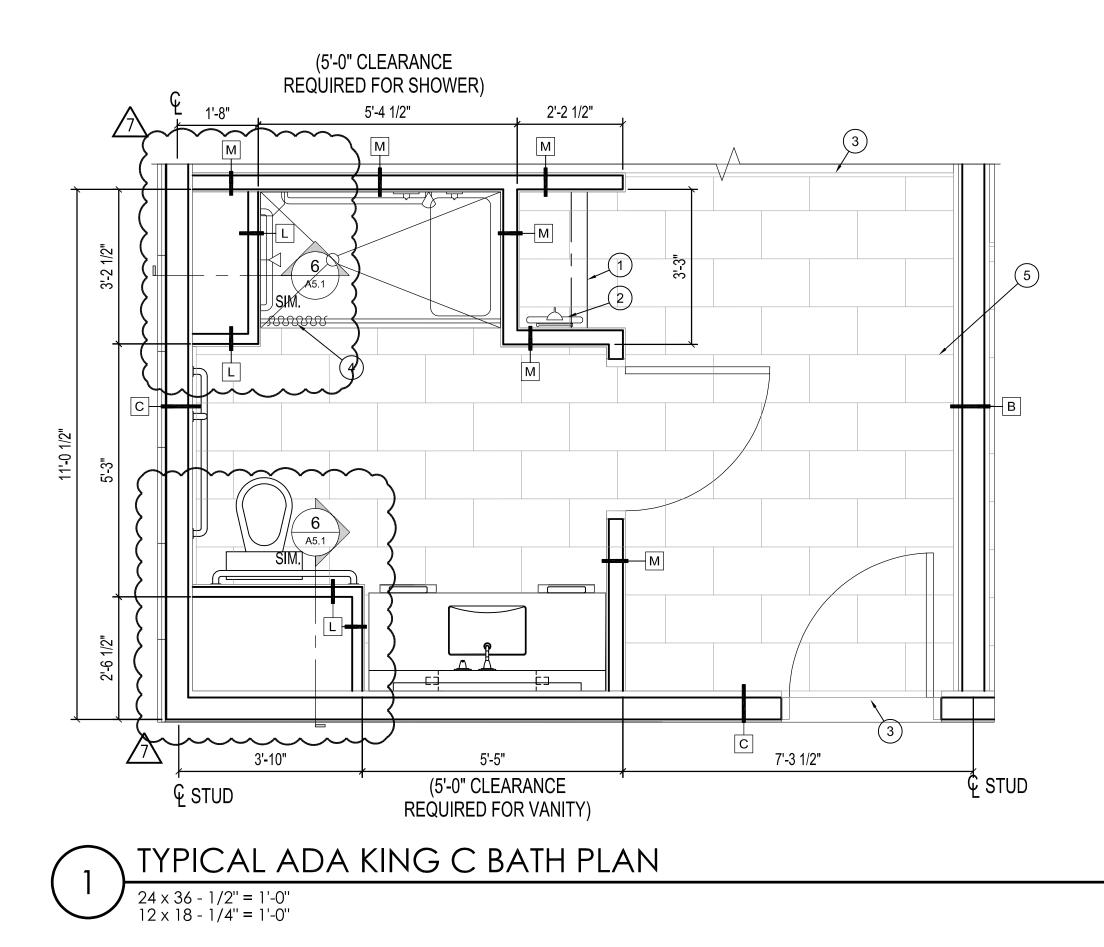

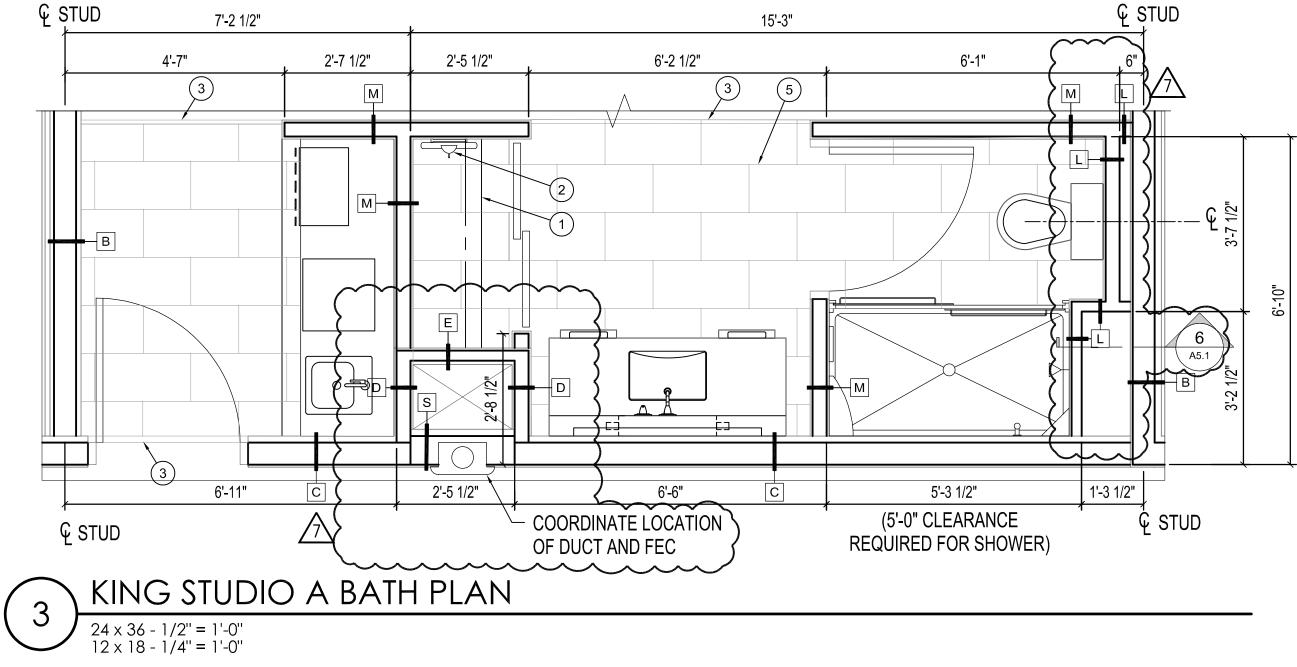

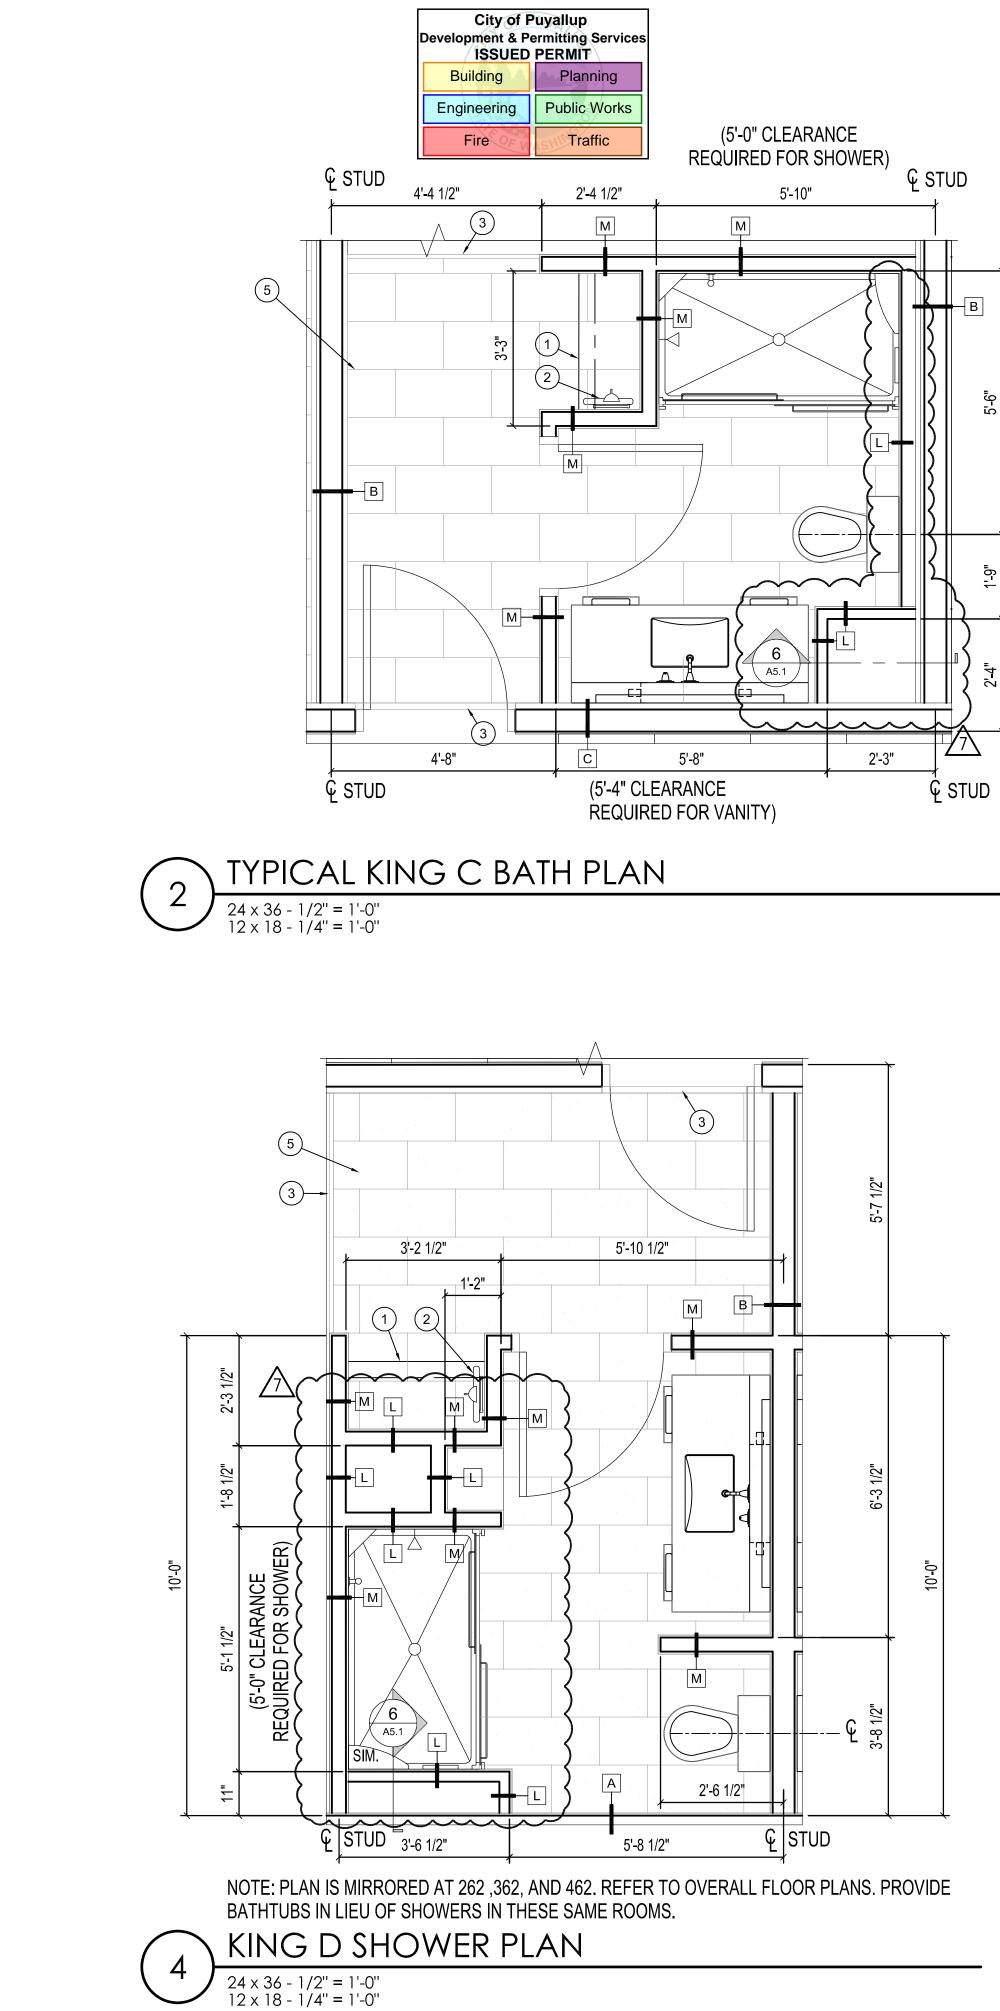

GENERAL NOTES

- A. CONTRACTOR TO FIELD VERIFY FRAMING AT ALL DOOR LOCATIONS FOR PROPER OPERATING CLEARANCE WITH VANITY CASEWORK.
- B. DIMENSIONS ARE TO FACE OF STUD OR TO CENTERLINE WHERE NOTED.
- C. CONTRACTOR TO FOLLOW DESIGN GUIDELINES FOR FINISHES AND EQUIPMENT TO PROVIDED WITHIN BATHROOMS. "PUYALLUP HAMPTON-ADD GR-FFE-SPECS 6-15-2023"
- D. COORDINATE ALL EQUIPMENT, FURNISHINGS AND FINISHES WITH THE HAMPTON INN STANDARDS

E. CONTRACTOR TO COORDINATE SHAFT WALL WITH OTHER RATED WALL COMPONENTS TO MEET UL RATING


······

ENLARGED BATH PLAN KEYED NOTES

1 SHELVING CASEWORK

- 2 IRONING BOARD PER HOTELS STANDARDS
- (3) RUBBER CARPET TO TILE TRANSITION STRIP PER DESIGN STANDARDS
- (4) SHOWER ROD CURTAINS PER HOTEL STANDARDS
- 5 NEW 12" x 24" CERAMIC TILE FLOORING AND GROUT, WITH TILE BASE PER DESIGN STANDARDS



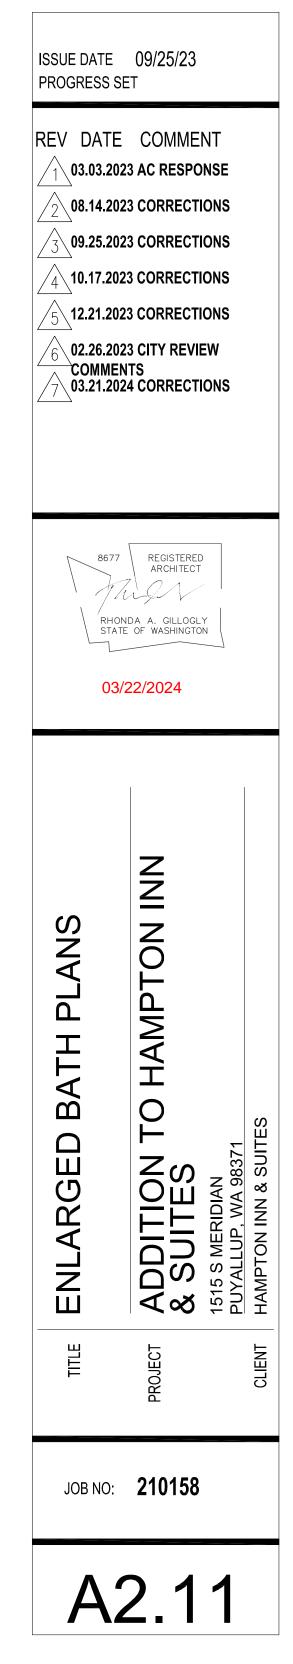

B-20-0078

