
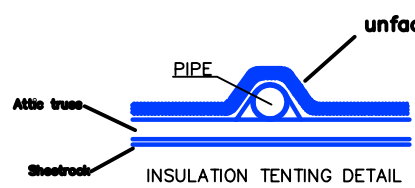
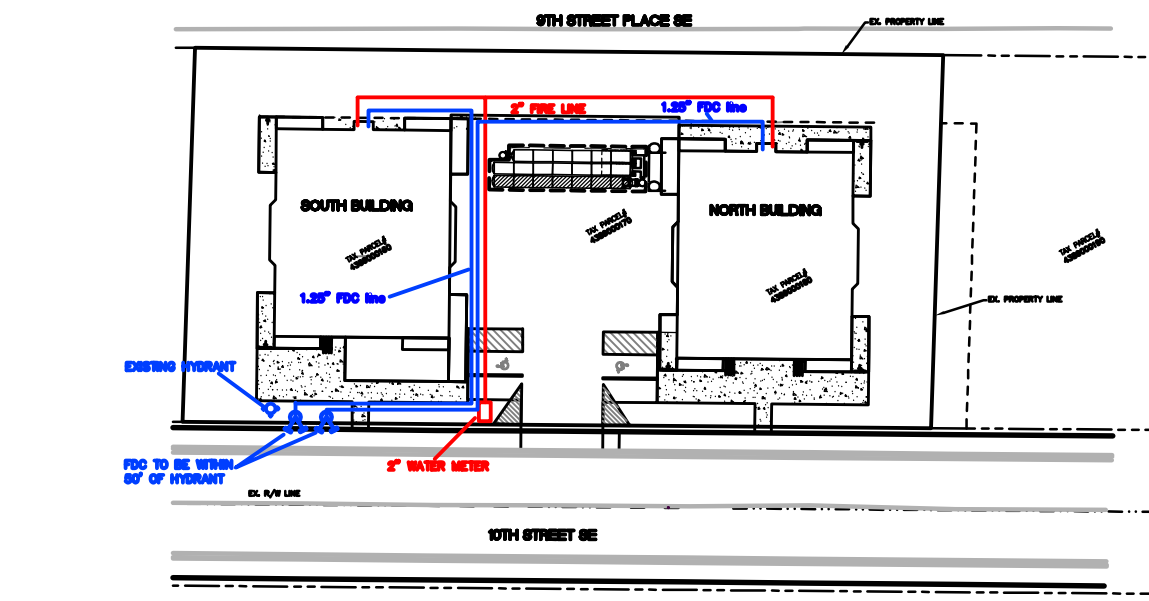


City of Puyallup
Development & Permitting Services
ISSUED PERMIT



Building	Planning
Engineering	Public Works
Fire	Traffic

THE APPROVED CONSTRUCTION
PLANS AND ALL ENGINEERING
MUST BE POSTED ON THE JOB AT
ALL INSPECTIONS IN A VISIBLE AND
READILY ACCESSIBLE LOCATION.


Approval of submitted plans is not an
approval of omissions or oversight by this
office or noncompliance with any
applicable regulations of local government.
The contractor is responsible for making
sure that the building complies with all
applicable building codes and regulations of
the local government.

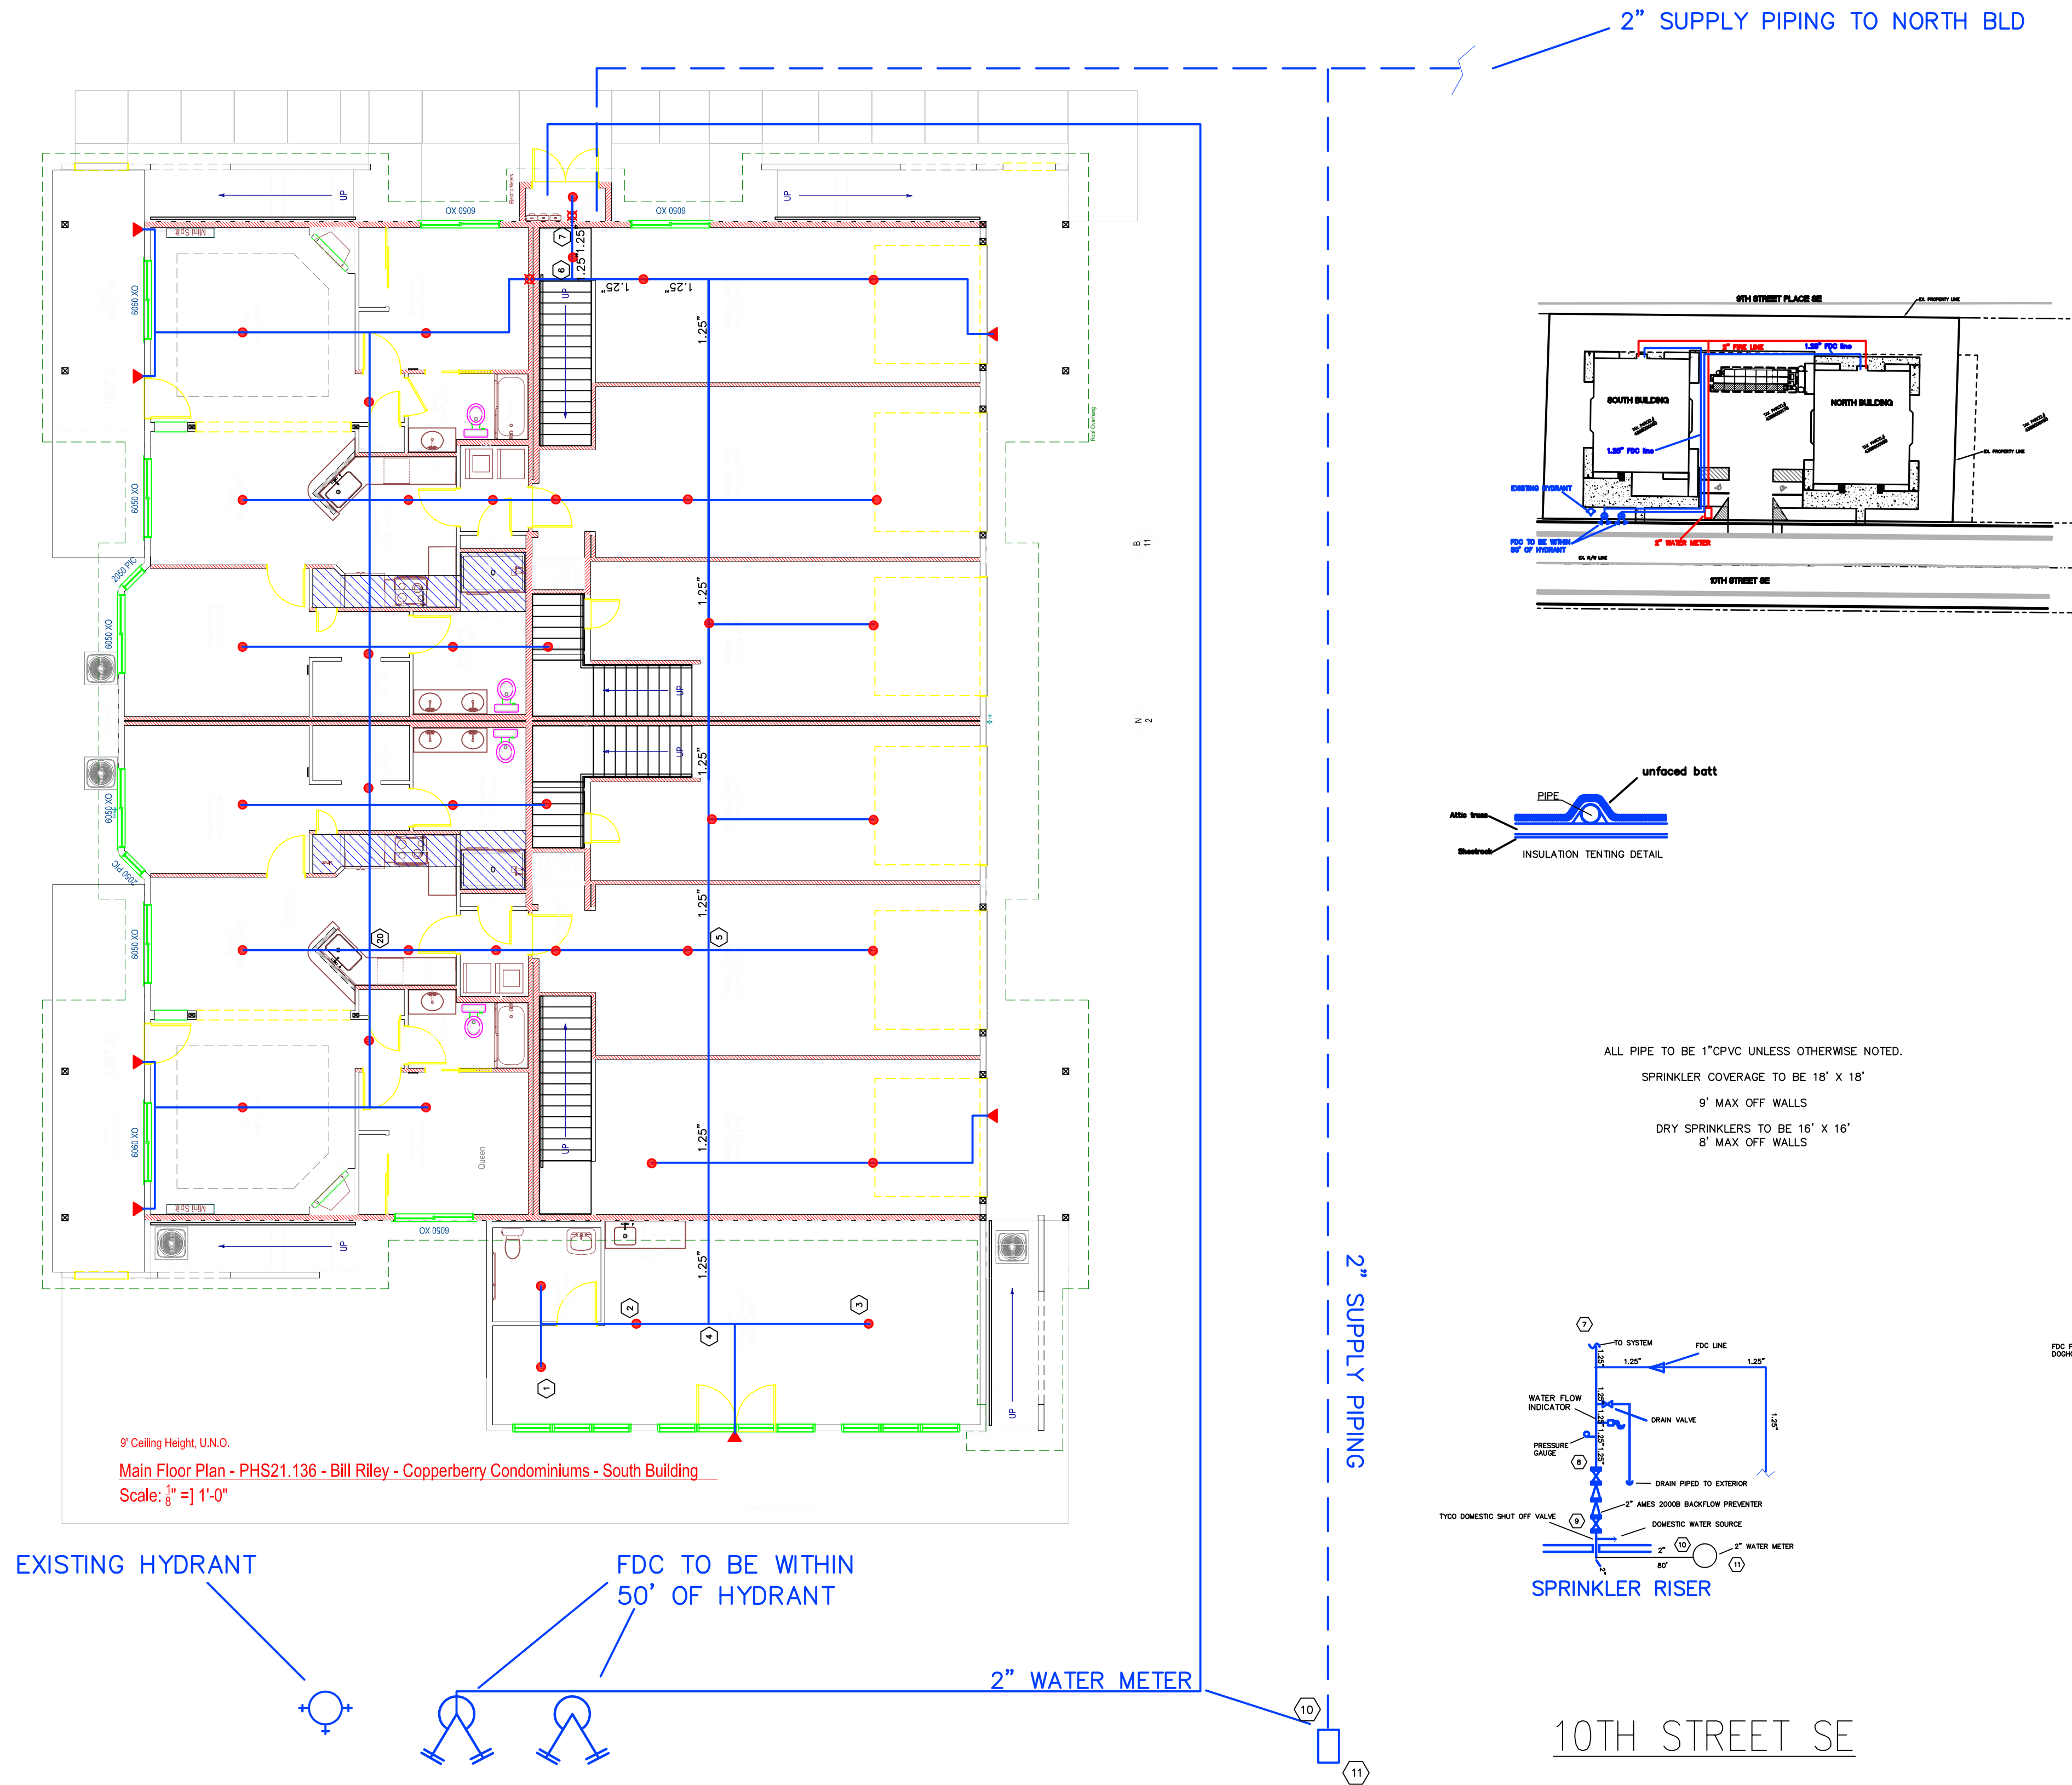

ALL PIPE TO BE 1" CPVC UNLESS OTHERWISE NOTED.
SPRINKLER COVERAGE TO BE 18" X 18"
9" MAX OFF WALLS
DRY SPRINKLERS TO BE 16" X 16"
8" MAX OFF WALLS

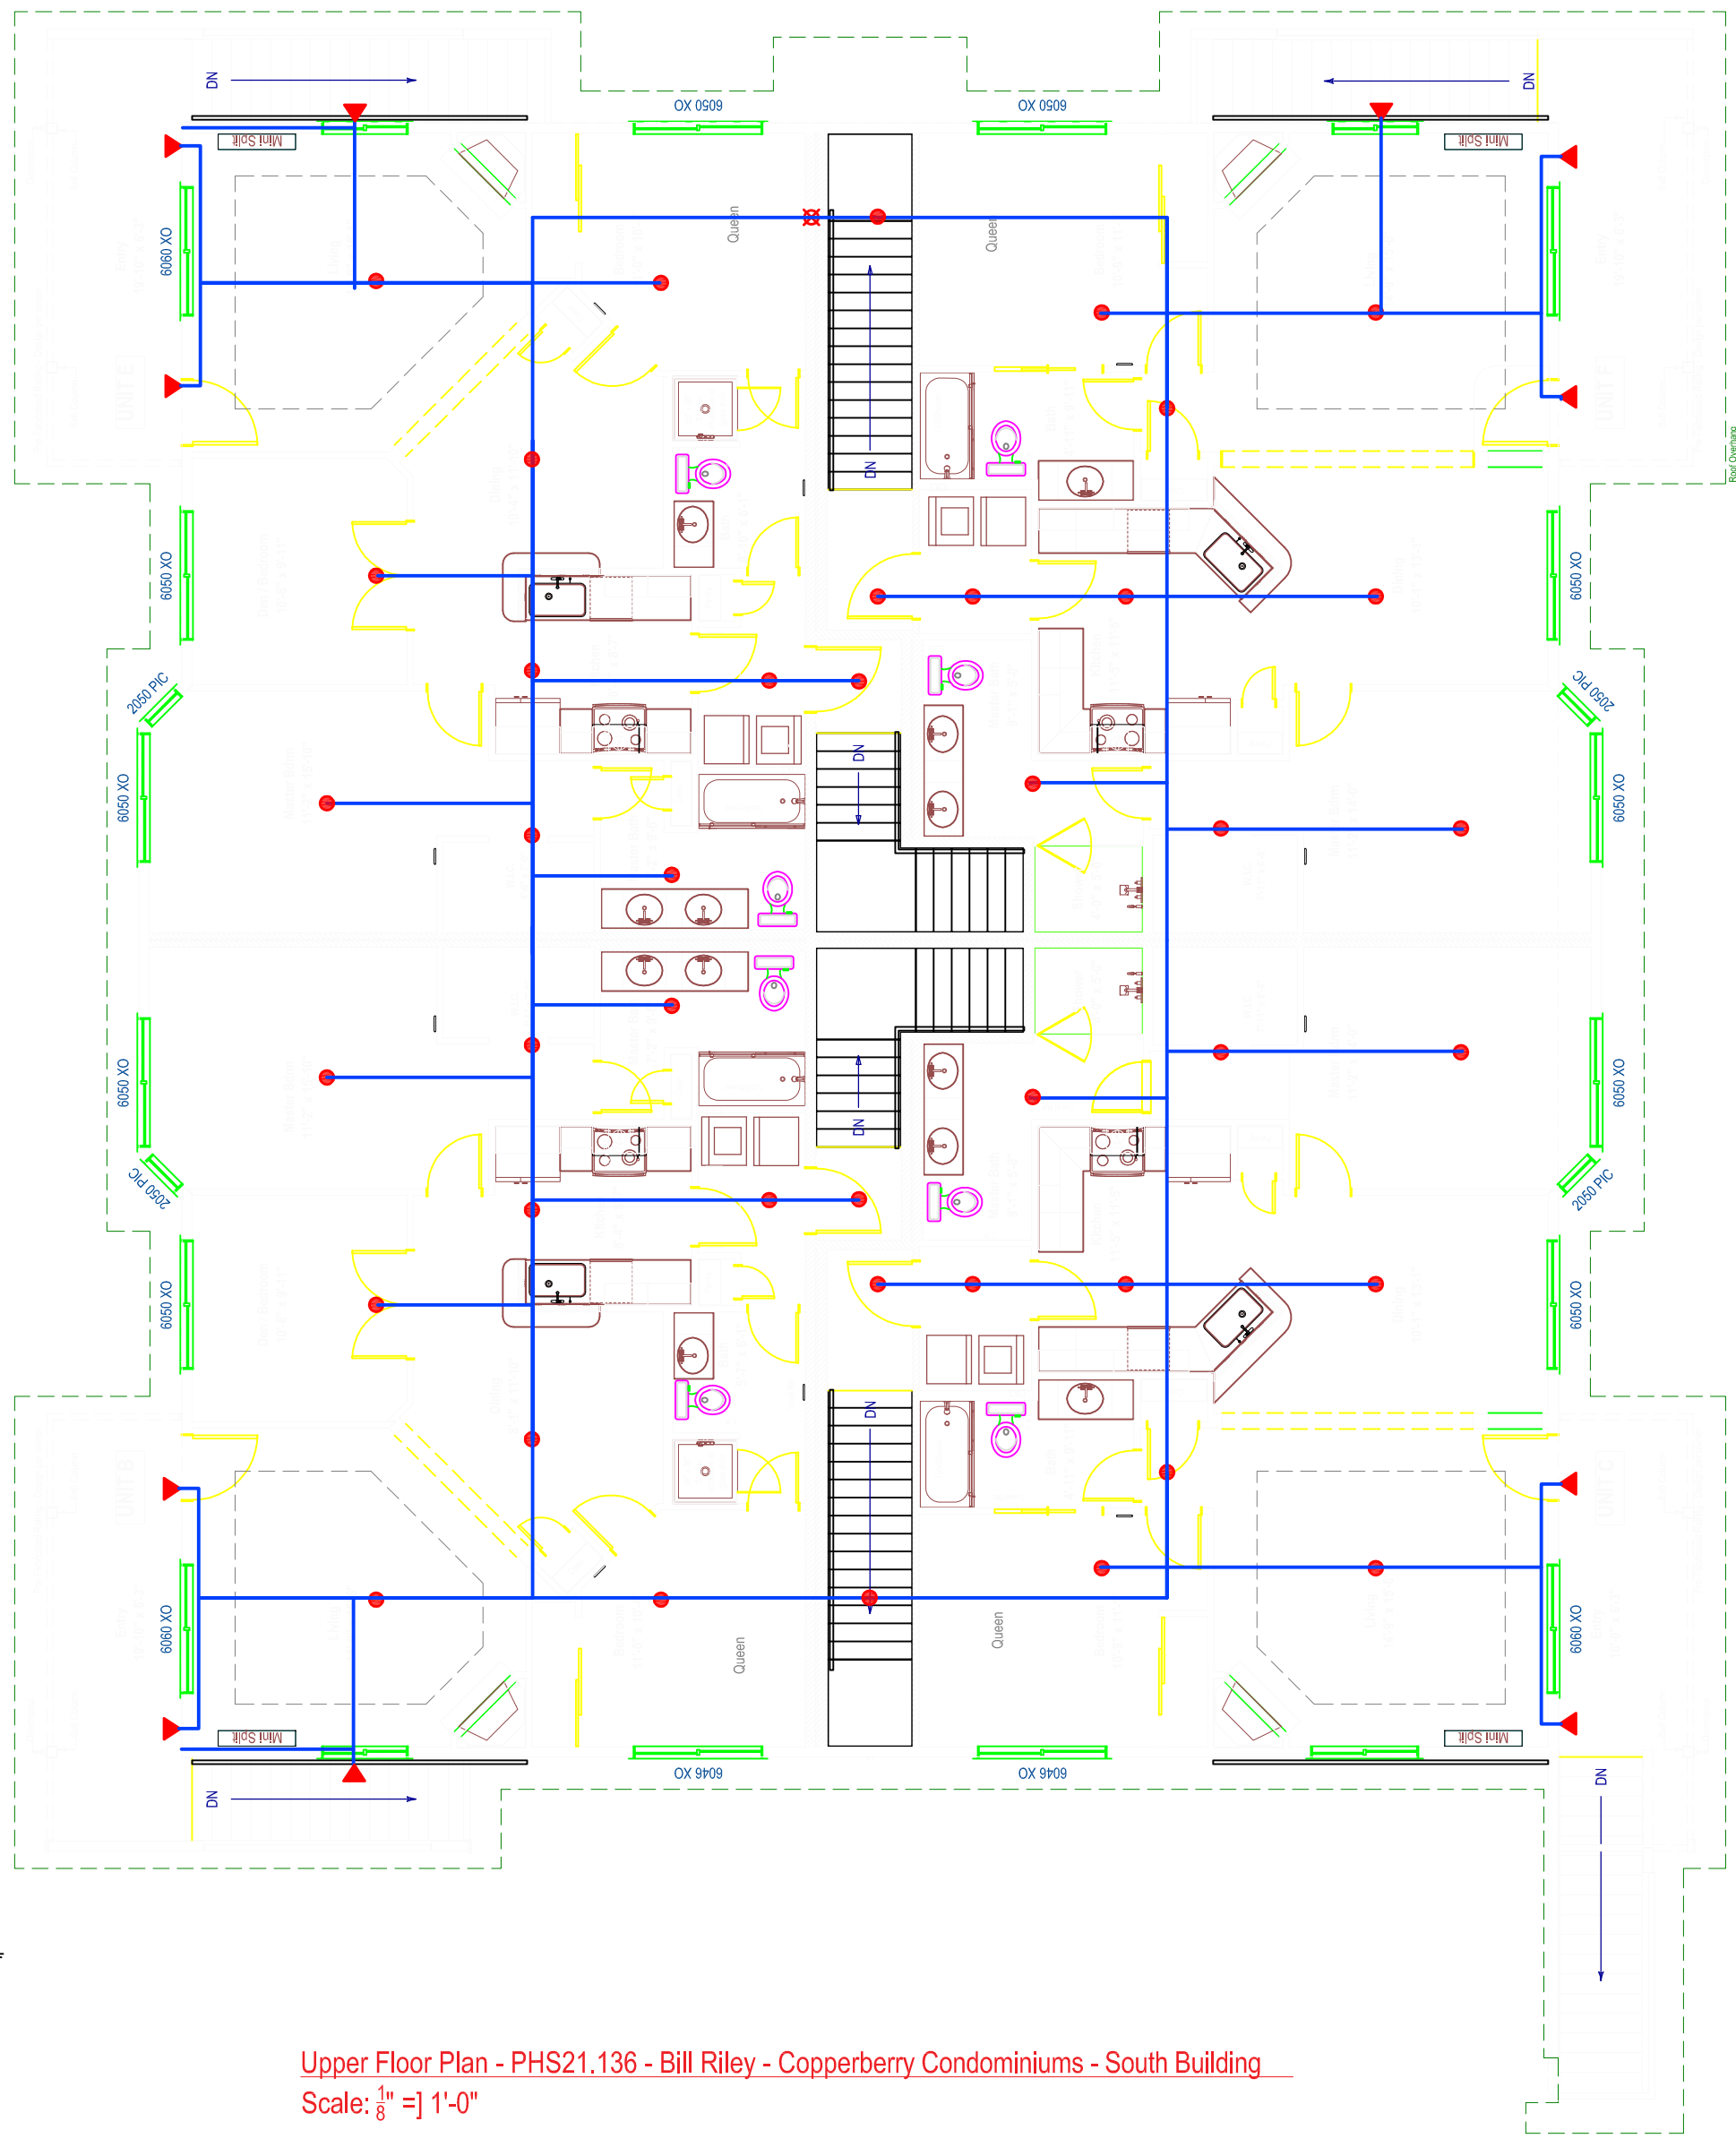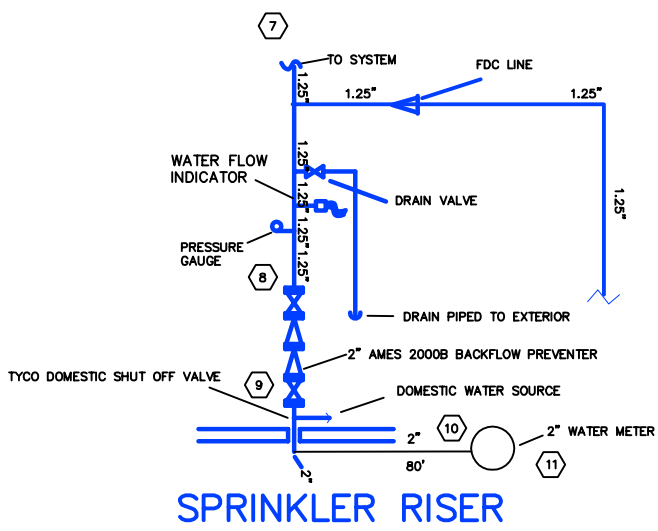

Upper Floor Plan - PHS21.136 - Bill Riley - Copperberry Condominiums - South Building
Scale: 1/8" = 1'-0"

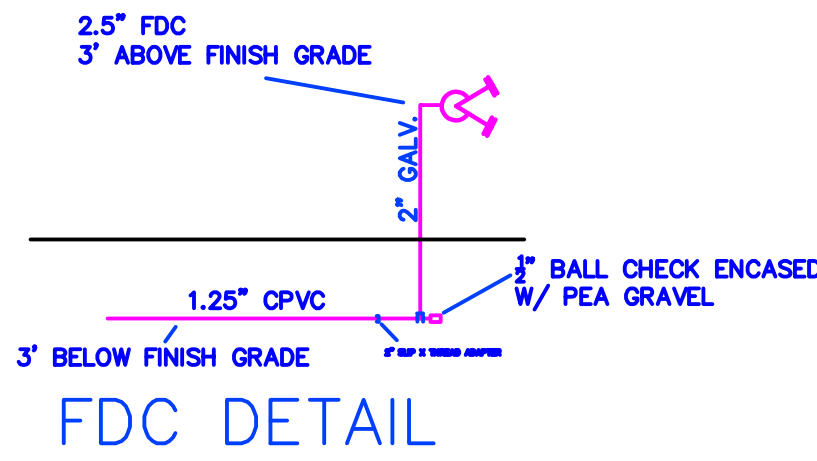

ALL PIPING TO BE BURIED AT A MINIMUM OF 3' WITH SAND BEDDING ABOVE AND BELOW PIPING.
ALL PIPING TO BE TESTED AT 200 PSI. FOR 2 HOURS.
ALL PIPING TO BE FLUSHED.
ALL TESTING TO BE WITNESSED BY CITY OF PUYALLUP FIRE INSPECTORS.
ALL SPRINKLER UNDERGROUND PIPING TO BE 1.25" CPVC.


Stamp

Expires 12/31/24
WASHINGTON STATE
CERTIFICATE OF COMPETENCY
FIRE SPRINKLER SYSTEMS

Michael D. Hutchinson
1166-0599-BG Level 2
Evergreen Fire Protection, Inc.
EVERGFP967LZ
4/2/24
Signature Date

City of Puyallup
Fire
REVIEWED
FOR
COMPLIANCE

DDrake
04/15/2024
9:25:52 AM

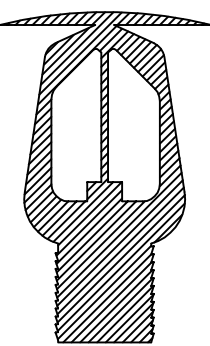


General Notes

- OWNER TO PROVIDE ADEQUATE HEAT (40°F. MIN) TO PREVENT SPRINKLER PIPES FROM FREEZING.
- CPVC PIPE SHALL HAVE HANGERS 6'-0" c/c AND NOT MORE THAN 6" FROM ANY SPRINKLER HEAD.
- ALL ATTIC PIPING TO BE TENTED WITH BATT INSULATION TO PREVENT FREEZING. GARAGE LEVEL PIPING TO BE REVERSE TENTED TO PREVENT FREEZING.
- ALL PIPING TO BE 1" C.P.V.C. U.N.O.

Sprinkler Symbol Legend both sheets total

SYM	SPRINKLER ORIFICE SIZE, TYPE & FINISH	QUAN	TEMP	K FACTOR
●	RELIABLE F1 RES 49 18"x18"	77	155°	4.9
▼	Reliable RES 44 DRY SIDEWALL 16" X 20"	18	155°	4.4
TOTAL		95		

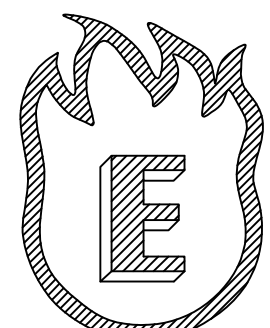

EVERGREEN FIRE PROTECTION INC.
PO BOX 998
Puyallup, WA 98371
EVERGFP967LZ
Phone: (253) 252-7942

DATE: 4/20/2023

REV:

DRAWN: MH

SHEET:

1 OF 2

Sheet Title

NFPA 13R FIRE PLAN
Copperberry Condominiums South Bld.

Job Title

NFPA 13R FIRE PLAN
4002 10th St se, Puyallup