


TYP. DRY SPRINKLER DETAIL SCALE: NONE

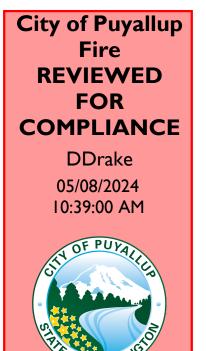

THE APPROVED CONSTRUCTION PLANS AND ALL ENGINEERING MUST BE POSTED ON THE JOB AT ALL INSPECTIONS IN A VISIBLE AND READILY ACCESSIBLE LOCATION.

City of Puyallup Development & Permitting Services ISSUED PERMIT				
Building	Planning			
Engineering	Public Works			
Fire OF W	Traffic			


Approval of submitted plans is not an approval of omissions or oversight by this office or noncompliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable building codes and regulations of the local government.

GENERAL NOTES

- 1. ----- DENOTES EXISTING FIRE SPRINKLER PIPING.
 2. DENOTES NEW FIRE SPRINKLER PIPING.
 3. DENOTES EXISTING FIRE SPRINKLER PENDENT TO REMAIN TO PENDENT TO PENDE
- DENOTES EXISTING FIRE SPRINKLER PENDENT TO REMAIN.
 DENOTES EXISTING FIRE SPRINKLER TO RELOCATE.


SCOPE OF WORK


MODIFY EXISTING FIRE SPRINKLER SYSTEM FOR T.I. WALLS & CEILINGS.

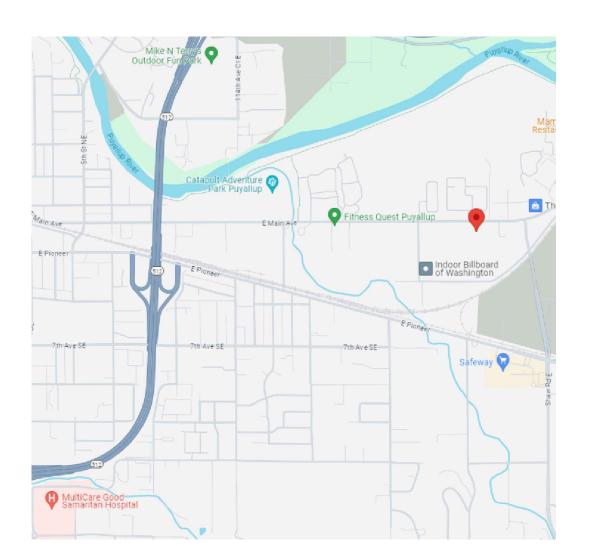

VICINITY MAP




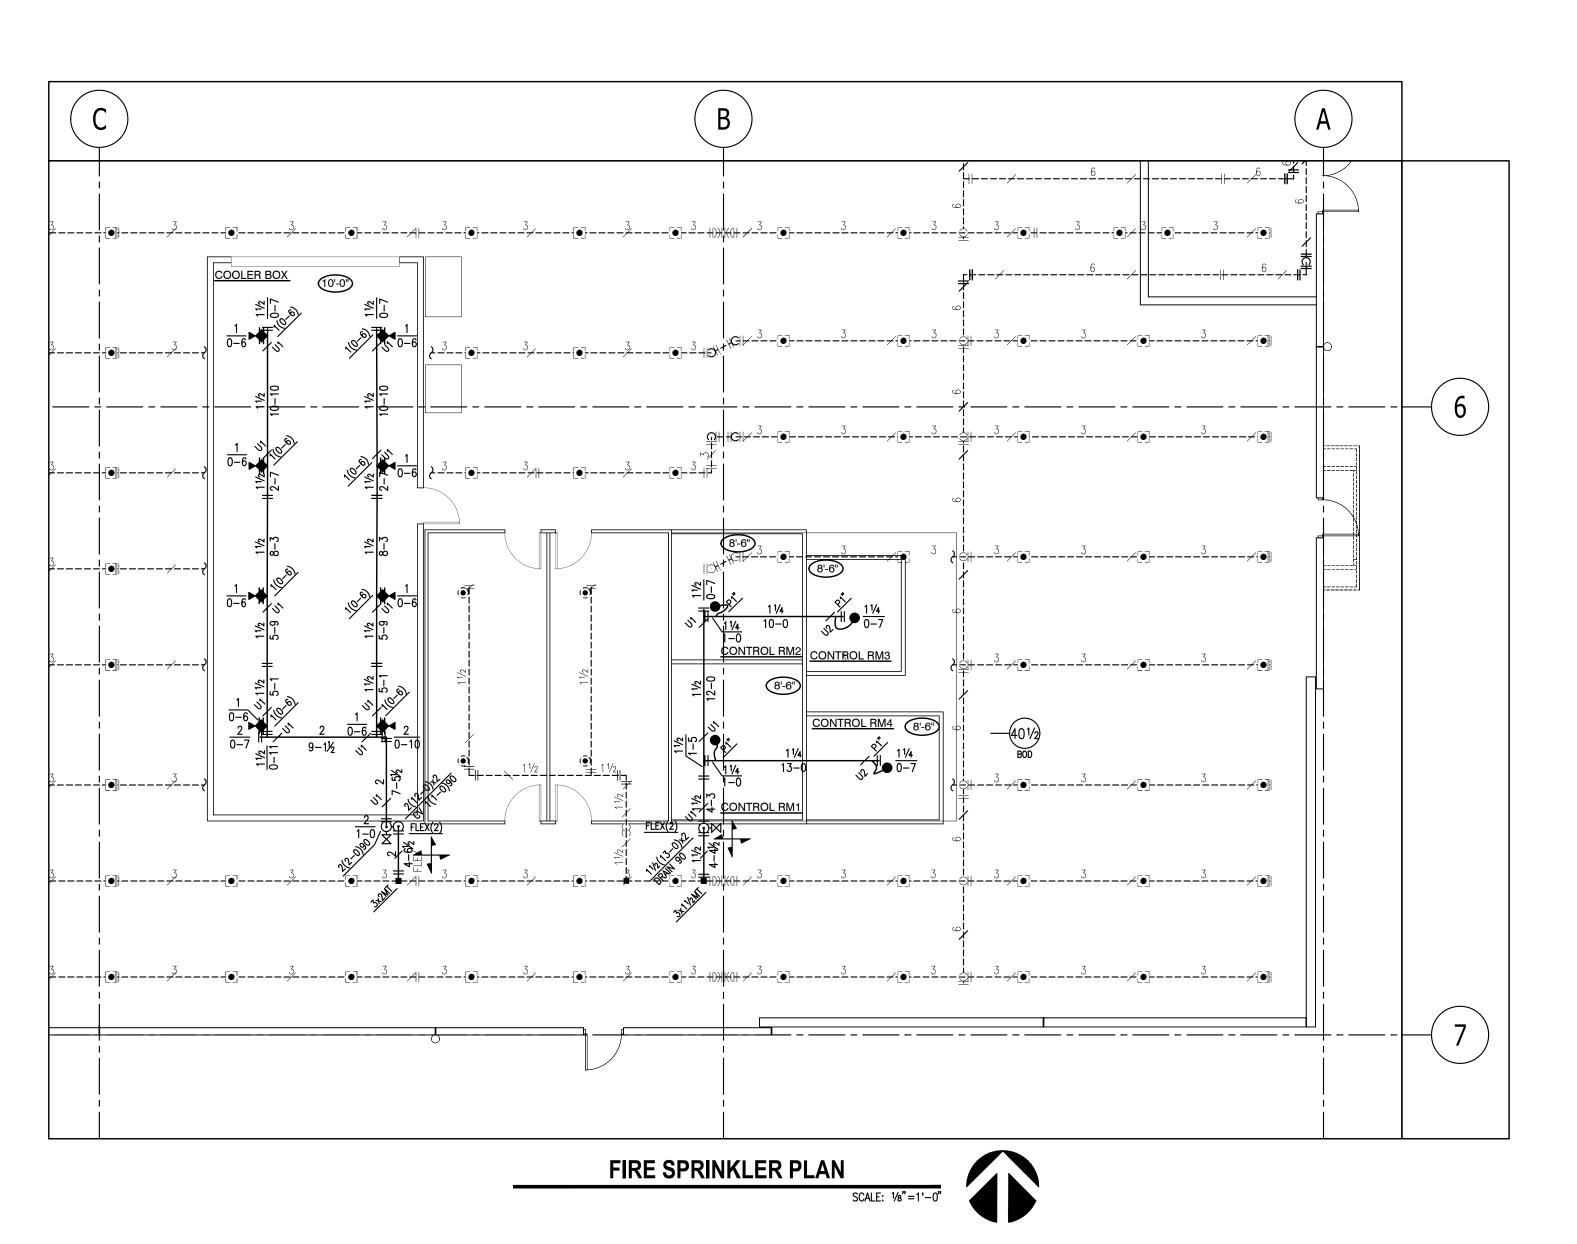

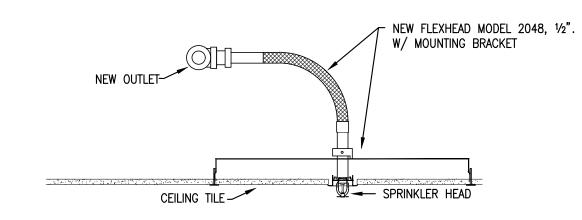


TYP. FLEXHEAD DETAIL

SCALE: NONE

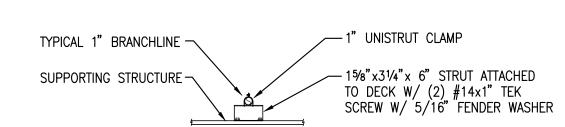

U1 HANGER DETAIL

2245 11215

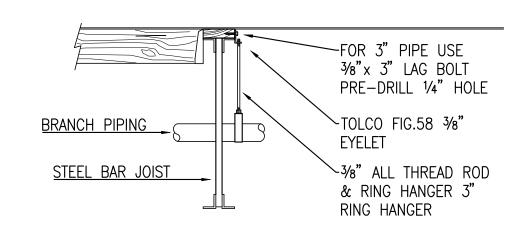

DECK HANGER DETAIL

SCALE: NONE

Ţ	STATE CERTIFICATION	FITTING LEGEND	HANGER LEGEND	QUALITY CONTROL BY DATE	DESIGN CRITERIA	CONTRACT WITH:
	P PIPE—O-LET SN GROOVED SHAPED NIPPLE SN GROOVED SHAPED NIPPLE TSN THREADED SHAPED NIPPLE ADN ADJUSTABLE DROP NIPPLE FLG FLANGE RC REDUCING COUPLING PATRIFPO9OCF PATRIFPO9OCF LINE OF PIPE IN INCHES KLER HEAD LEGEND P PIPE—O-LET SN GROOVED SHAPED NIPPLE TSN THREADED SHAPED NIPPLE ADN ADJUSTABLE DROP NIPPLE FLG FLANGE RC REDUCING COUPLING STRUCTURE TO CENTER LINE OF PIPE IN INCHES KLER HEAD LEGEND PATRIFPO9OCF SIgnative PATRIFPO9OCF A "U" HOOK B COACH SCREW ROD D BM. CLAMP W/ "STRAP E EYELET F FLUSH SHELL G CEILING FLANGE F FLUSH SHELL G CEILING FLANGE H SIDE BEAM BRACKET K SHORT CLIP NFPA PAMPHLET NO. 13, 2013 EDITION. SIGNATION OF PIPE IN INCHES A "U" HOOK B COACH SCREW ROD CENERAL NOTES 1. ALL MATERIAL AND EQUIPMENT TO BE NEW AND UL LISTED OR FM APPROVED. 2. PIPE DIMENSIONS ARE CENTER TO CENTER EXCEPT RISERS & DIMENSIONS SHOWN THUSLY (X-X) WHICH ARE END TO END. STRUCTURE TO CENTER LINE OF PIPE IN INCHES KLER HEAD LEGEND A "U" HOOK B COACH SCREW ROD D BM. CLAMP W/ "STRAP E EYELET C CEILING FLANGE SHOWN THUSLY (X-X) WHICH ARE END TO END. STRUCTURE TO CENTER LINE OF PIPE IN INCHES A "U" HOOK B COACH SCREW ROD D BM. CLAMP W/ "STRAP E EYELET C EYELET SN SHOWN THUSLY (X-X) WHICH ARE END TO END. SHOWN THUSLY (X-X)	GENERAL NOTES 1. ALL MATERIAL AND EQUIPMENT TO BE NEW AND UL LISTED OR FM APPROVED. 2. PIPE DIMENSIONS ARE CENTER TO CENTER EXCEPT RISERS & DIMENSIONS SHOWN THUSLY (X-X) WHICH ARE END TO END. 3. EARTHQUAKE BRACING SHALL BE PROVIDED IN ACCORDANCE WITH NFPA PAMPHLET NO. 13, 2013 EDITION. 4. PIPE HANGERS AND METHOD OF HANGING TO BE IN ACCORDANCE WITH NFPA PAMPHLET NO. 13, 2013 EDITION.	PIPE NOTES 1. WELDED/GROOVED MAIN PIPING TO BE SCH. 10 BLACK PIPE 2. THREADED PIPING TO BE SCH. 40 BLACK PIPE.	PROJECT NAME: RED DOT CORP. 495 ANDOVER PARK E TUKWILLA, WA 98188 PROJECT NAME: RED DOT CLIMATE CONTROL RM 2504 EAST MAIN PUYALLUP, WA 98372		
■ RELIABLE F1FR 56 RA1414 QR RECESSED GFR2 ½" K=5.6 CHROME CHROME 155' 4 ■ RELIABLE F3QR R5714 QR DRY PENDENT XLO2 1" K=5.6 CHROME CHROME 286' 8	APPROVAL REQUIRED CITY OF PUYALLUP TEMP RATING	$\begin{array}{c ccccccccccccccccccccccccccccccccccc$	P POWDER DRIVEN STUD R EXPANSION BOLT P PIPE SPIKE T TRAPEZE HANGER U V W WALL BRACKET HANGER X Y Z	7. OWNER TO PROVIDE ADEQUATE HEAT IN AREAS PROTECTED BY A WET PIPE SPRINKLER SYSTEM TO PREVENT WATER IN PIPES FROM FREEZING. 8. ALL WIRING OF ELECTRICAL DEVICES (IF REQUIRED) TO BE PROVIDED BY OTHERS. 9. PAINTING OF PIPE & EQUIPMENT (IF REQUIRED) TO BE PROVIDED BY OTHERS. 10. FURRING OF PIPE & EQUIPMENT (IF REQUIRED) TO BE PROVIDED	REVISIONS NO DATE BY DESCRIPTION	PATRIFPOS WWW.PATRIOTFIRE. travis.mackey@patriotfile FIRE PROTECTION, INC. 2707 70TH AVENUE EAST TACOMA, WA 98424 DESIGNER Travis Mackey DATE 4/10/24 JOB NO. 12-23662 PATRIFPOS WWW.PATRIOTFIRE. travis.mackey@patriotfile FIRE SPRINKLERS SAVE II TEL: (253) 926- FAX: (253) 922- FAX: (253) 922-