

Bradley Heights Apartments

A 236-Unit Apartment Development Puyallup, Washington

Bradley Heights SS LLC

PROJECT TEAM

Owner/Developer	Bradley Heights SS LLC 614 Boylston Ave E Seattle, WA 98102 (206) 557-7236
Architect	Milbrandt Architects, Inc., P.S. 25 Central Way, Suite 210 Kirkland, WA 98033 (425) 454-7130
Structural Engineer	Solutions 4 Structure, Inc. 11605 135th St Ct E Puyallup, WA 98374 (253) 268-2923
Civil Engineer	Azure Green Consultants 409 East Pioneer Puyallup, WA 98372 (253) 770-3144
Landscape Architect	Nature By Design 1320 Alameda Avenue, Suite B Fircrest, WA 98466 (253) 460-6067
MEP Engineer	Robison Engineering Inc. 19401 40th Avenue W, Suite 302 Lynnwood, WA 98036 (206) 364-3343

PROJECT INFORMATION

Site Address:	202 27th Ave SE, Puyallup, WA 98374
Project Description:	Construction of 236 wood framed apartment units in eight stacked flat buildings along with a leasing amenity building.
Site Area:	7.785 acres (+/- 339,107 SQ. FT.)
Tax Parcel Number:	1 419036006
Occupancy Type:	All Apartment Buildings are R2 occupancy.
Type of Construction	All Apartment Buildings are Type V-B construction with NFPA 13R automatic sprinklers .
Applicable Codes:	2018 International Building Code 2018 Uniform Plumbing Code 2018 Washington State Energy Code 2018 International Mechanical code 2018 International Fire Code 2022 National Electrical Code ICC/ANSI A117.1-2009 Standard Washington State Amendments as modified and adopted by the local jurisdiction.

RATED ASSEMBLIES

Rated assemblies shall be provided in accordance with IBC section 420

Assembly	Fire Rating	Detail
Common walls separating dwelling units:	1-hour	4/D1
Exterior walls:	non-rated	1/D1
Interior bearing walls:	non-rated	2/D1
Interior non-bearing walls:	non-rated	2/D1
Corridor-to-unit walls:	1-hour	3/D1
Floor/ceiling:	1-hour	13/D1
Roof/ceiling:	1-hour	17/D1
Penetrations (firestopping)	Per situation	17/D7
Membrane penetrations by ducts in ceiling	26 ga. steel ducting	6/D7
Stair fire barrier wall:	1-hour @ 3-story 2-hour @ 4-story	3/D1 7/D1

Fire Alarm systems and smoke alarms shall be provided in accordance with IBC section 420.5 Refer to unit plan sheets for smoke detector locations and requirements.

GENERAL NOTES

- Comply with 2018 IBC and all applicable codes and ordinances of the local jurisdiction and the State of Washington.
- Do not scale drawings.
- Verify all rough-in dimensions for equipment provided in this contract or by others.
All rough-ins shall be approved and fireblocking shall be installed prior to framing inspection.
- Verify size and location of and provide all openings through floors and walls, furring, anchors, inserts, rough bucks and backing for surface mounted items.
- Provide furring as required to conceal mechanical and electrical work in all finished areas.
- All swinging doors not located by dimensions on plans, interior elevations, or details shall be 3" from face of stud to edge of rough openings or centered between room partitions as shown.
- Plans are drawn assuming the following rough openings:
Swinging doors: Nominal size +2".
Bi-Fold doors: Nominal size +1-1/2".
Bi-Pass doors: Nominal size +0".
Windows: Nominal size +0".
Sliding glass doors: Nominal size +0".
- Fill where required with earth free from organic material. Compact fill in 12" layers maximum.
- "Finish Floor" refers to the top of concrete slab or top of wood floor sheathing .
- Exterior walls shall be 2x6 studs at 16" o.c. and interior walls shall be 2x4 studs at 16" o.c., unless noted otherwise.
- Unless otherwise noted, plan dimensions are to face of studs and face of concrete walls.
- Refer to interior elevations for cabinet and counter lengths, dimensions, countertop materials and detail reference. Verify all existing dimensions before installation.
- Provide caulking between sole plates and subfloor and between rim joists at both top plate and subfloor.
- Hydrants shall be in service prior to start of framing.
- Through penetrations and membrane penetrations of rated wall or floor/ceiling assembly will require firestopping per 2018 IBC Section 714. See detail 7/D7 for diagram of specifics.
- Shall be no asbestos used on this project.
- All Tub-Shower valves installed shall conform to UPC 408.3 & ASSE 1016 or ASME A112.18.1
- Milbrandt Architects is not responsible for construction means, methods, techniques or procedures, or for the safety precautions and programs in connection with the work, and is not responsible for the failure of any contractor or subcontractor to carry out the work in accordance with the various contract documents and or governing jurisdiction, regardless of what is shown on these drawings.

FEDERALLY DECLARED SAFE HARBOR

Declared Safe Harbor: HUD Fair Housing Accessibility Guidelines published on March 6, 1991 and the Supplemental Notice to Fair Housing Accessibility Guidelines: Questions and Answers about the Guidelines, published on June 28, 1994.

ACCESSIBILITY

Design is based on the 2018 IBC Chapter 11 which has been amended by the State of Washington, & 2009 ICC A117.1 Accessible & Useable Buildings & Facilities.

- None of the buildings are an elevator type building.
- There are a total of 84 one-story dwelling units at ground level. All ground floor units are 1 or 2-bed unit designs. Provided total 84 accessible units: 12 Type A and 72 Type B units.
- Type A units meet the requirements for Type B units.
- The 12 Type A units are proportioned as follows (see Site Plan):
- (7) 1-Bed units (1 BR) in each of Buildings A, C, D, E, F & G - for a total of 7.
 - (5) 2-Bed units (2 BR) in Buildings A, D, E, F & G - for a total of 5.

Parking:
Section 1106.2 IBC requires 2% of each proposed parking stall type to be accessible.
Of the 354 total open stalls, 12 are accessible, including 5 van stalls. Each accessible open stall is indicated by the wheelchair symbol on the site plan and further designated by the detail symbols 10/A3.

VENTILATION NOTES

- Design Criteria: 2018 International Mechanical Code with Washington State Amendments.
- System Type: Balanced whole house fan system with energy recovery ventilator
- Use: Group R occupancy.
- Specifics: See mechanical plans by others.

ENERGY NOTES

Reference: 2018 WSEC
Chapter 4 using climate zone category 5 & marine 4 for all calculations.

All residential units shall comply with the Requirements By Component Table 402.1.1. Including but not limited to the following:

Code Requirements	Associated Notes/Details Showing Compliance
Window U-Factor	.24 or better See Insul. Notes on sheets U1, U2, U3, U4, U5
Ceiling R-Value	R-49 13 / D1
Wood Frame Wall R-Value	R-21 int. 1, 3, 4, 7 & 8 / D1
Floor R-Value	R-30 N/A
Slab R-Value & Depth	R-10, 2ft 1, 3, 5 & 6 / D2

"int." (intermediate framing) denotes standard framing 16" o.c. with headers insulated with a min. of R-10 (see 6/D6).

All units need to have a certificate posted within 3 feet of the electrical distribution panel listing the following information: R-values, U-values, duct air leakage test results, building envelope air leakage test results, types and efficiencies of heating, cooling and service water heating equipment per R401.3

All insulation shall comply with table R402.4.1.1 WSEC
Hot water piping shall be insulated to a minimum of R-3 per R403.5.2
Water heaters in unheated spaces, or on concrete floors shall be placed on minimum of R-10 incompressible insulated surface per R403.5.5
Mechanical ventilation shall be provided per R403.6
A minimum of 90% of all permanently installed lamps in lighting fixtures shall be high-efficacy lamps per R404.1

See Insulation Notes on the Unit Plans, and Insulation and Energy Notes on sheet 17.

Energy Credits used (see 2018 WSEC table 406.3 for all requirements):

Fuel Normalization Credit System Type 3	-1.0 CREDITS
Option 1.1 Efficient Building Envelope	0.5 CREDITS
Option 2.1 Air Leakage Control	1.0 CREDITS
Option 5.5 Efficient Water Heating	2.5 CREDITS
Option 7.1 Appliance Package	1.5 CREDITS
TOTAL PROVIDED	4.5 CREDITS

Revise to match 2018 Prescriptive Energy Code Compliance report. Page A

Report selected 1.7 credit; plans show 1.1 credit

FIRE SYSTEMS

Buildings shall have an NFPA 13R sprinkler system installed throughout per 2018 IBC Section 903.3.1.2 which shall include a notification appliance which is activated upon sprinkler flow. Any alarms, bells or lights required due to the design of the sprinkler system or integral with the sprinkler system shall be considered part of the sprinkler system. The sprinkler system design, therefore, needs to include any and all integrated alarms.

Plans and specifications for sprinklers shall be submitted to the city of Puyallup as a separate permit for review and approval before installation.

DESIGN LOADS

See structural notes. Sheet S1.0


DEFERRED SUBMITTALS

Shop drawings and calculations are required for:

- Firestopping details. Firestopping methods and materials shall be determined by the Contractor except where details or notes are indicated in these drawings. Firestopping locations are indicated in part by detail 17/07. Contractor shall submit UL assembly details and product cuts of all relevant situations to the Architect for conformance to the building design. Upon the Architect's approval, they shall be submitted to the Building Official for approval. Firestopping shall not be installed without City approval.

SEPARATE PERMITS



The following required permits will be submitted separately:
1. Automatic Fire Sprinkler System (See fire systems note, this sheet).
2. Fire Alarm System.

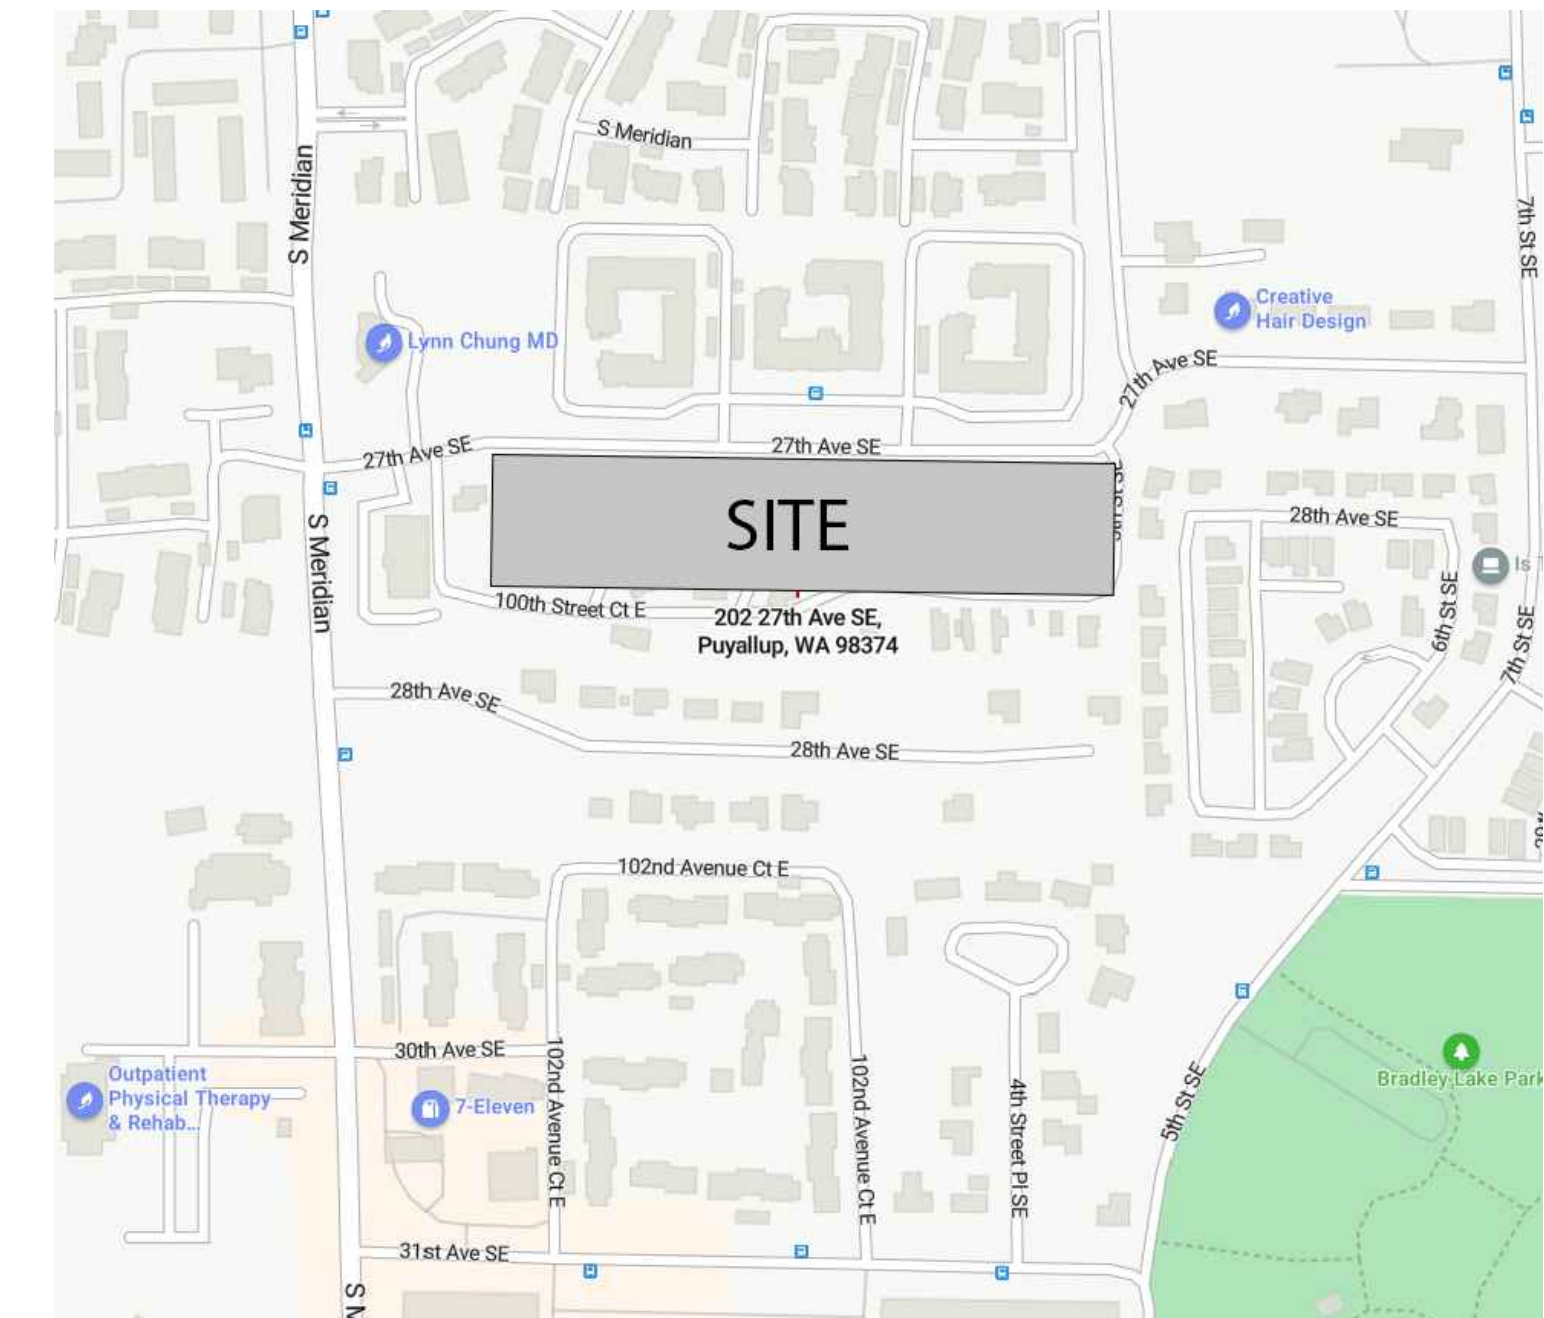

VICINITY MAP



Sunset Garden Senior Living Apartments

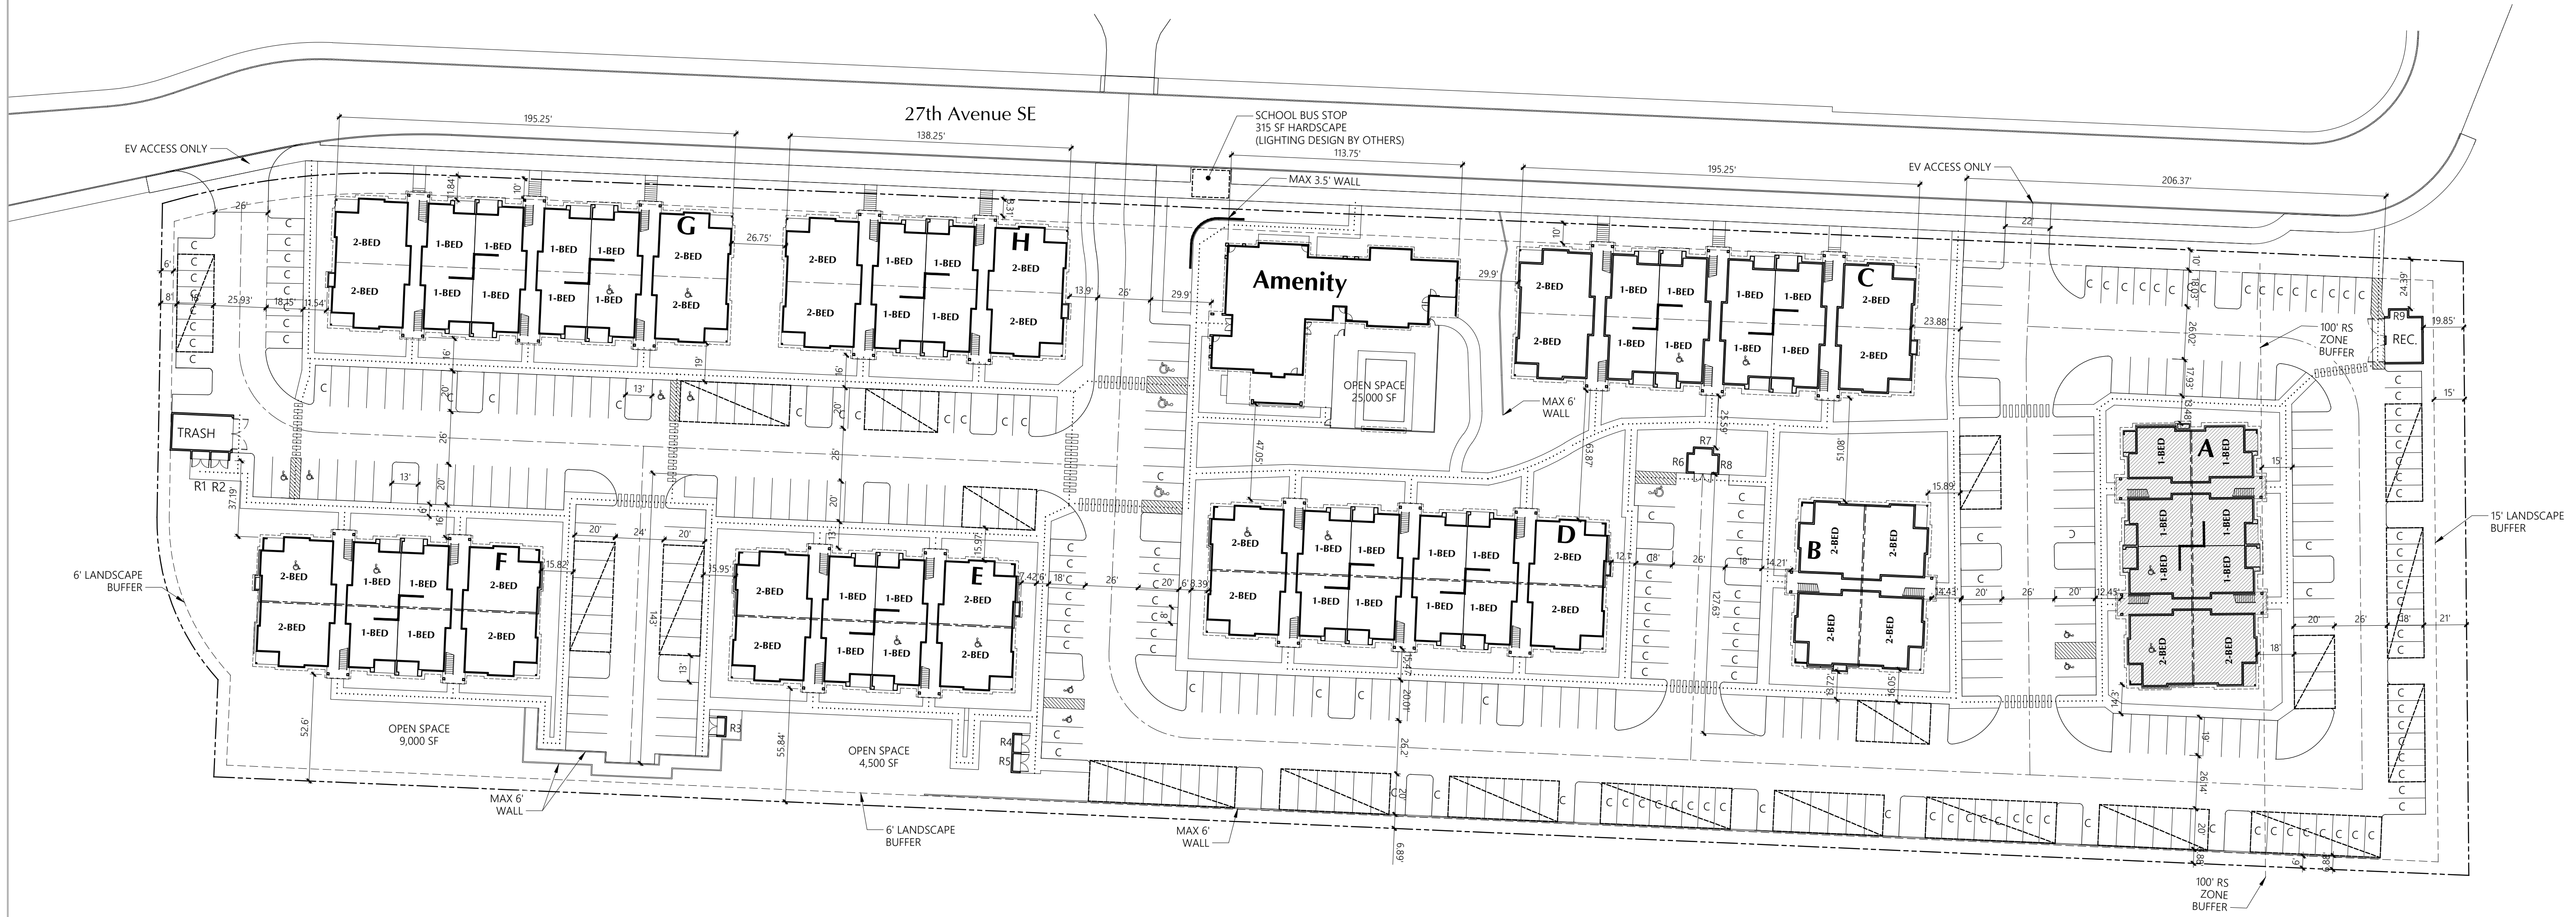

SITE PLAN 236 UNITS
1" = 40'


SITE INFORMATION

SITE ADDRESS: 202 27th Ave SE, Puyallup, WA
PARCEL #: 419036006
SITE AREA: 339,107 SF (7.785 Acres)
ZONE: RM-CORE
SETBACKS: NORTH/FRONT: 10 FT setback to buildings
WEST/SIDE: 0 FT Building setback - 6 FT landscape buffer
SOUTH/REAR: 0 FT Building setback - 6 FT landscape buffer
EAST/SIDE: 25 FT Building setback - 15 ft landscape buffer
BUILDING HEIGHT: 50' Max
DENSITY: Min 16 units per acre (125 units)
no Max density
LOT COVERAGE: Max 90%
LANDSCAPE AREA: Min 10% of net lot area (33,910 SF)
OPEN SPACE: 10% of net lot area (33,910 SF)
38,500 SF provided
PRIVATE OPEN SPACE: 60 SF per ground floor unit
10' x 6' per upper story unit
PARKING: 1.5 PARKING SPACES PER UNIT
Required Parking: 354 Stalls
Provided Parking: 354 Stalls
EASEMENTS: no existing easements on site

PARKING SUMMARY		
Parking Stalls Required		354
Standard Stalls		118
Compact Stalls	41.5%	100
Parallel Stalls		0
Carport Stalls		124
Attached Garage Stalls		0
Detached Garage Stalls		0
Accessible Standard Stalls		6
Accessible Van Stalls		5
Accessible Parallel Stalls		0
Accessible Carport Stalls		1
Accessible Garage Stalls		0
Tandem Stalls		0
Tandem Garage Stalls		0
Subtotal	354	1.50 Stalls / D.U.
Aprons		0
Total Parking Stalls Provided	354	1.50 Stalls / D.U.

UNIT COUNT	
1 BED	137 (58%)
2 BED	99 (42%)
TOTAL	236

Provide egress plan with all dimensions with travel distance for all floors.
Page A2

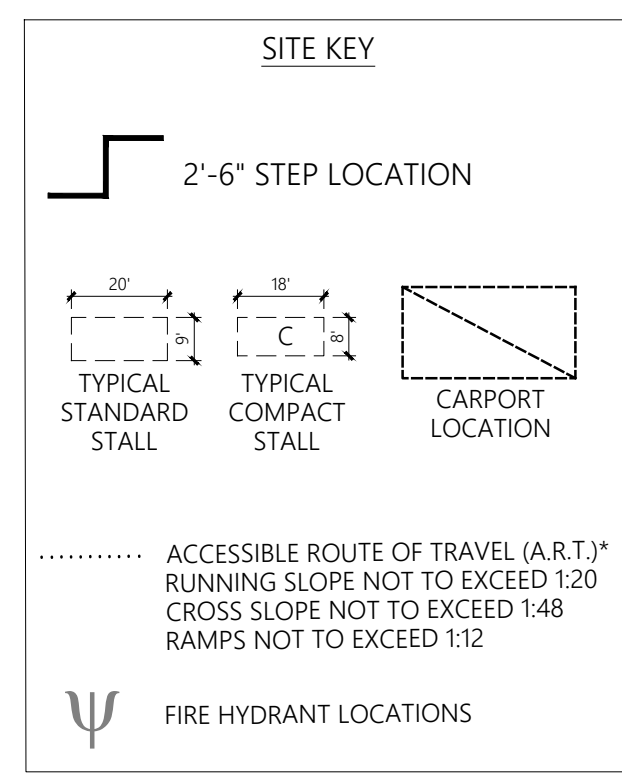

- SITE NOTES**
- 1) TYPICAL SIDEWALK WIDTH IS 6'
 - 2) A MINIMUM CLEAR WIDTH OF 44" IS REQUIRED FOR ALL EXTERIOR ACCESSIBLE ROUTES PER WASHINGTON STATE AMENDMENT SECTION 1101.2.1

Site Plan
Building A


Bradley Heights Apartments
Puyallup, Wa

Timberlane Partners

Revisions
No. Date Description

Initial Publish Date:
Date Plotted: 2-20-24
Job No.: 23-06 Drawn By: APT/HDM
Sheet No.:

LEGEND

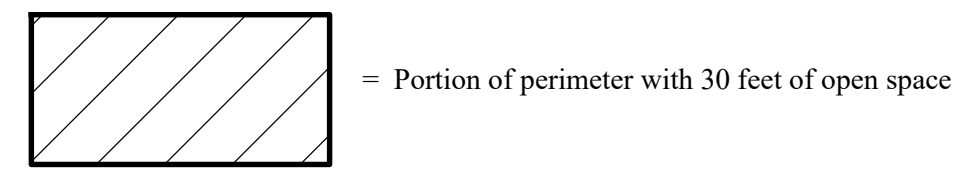

FRONTAGE INCREASE TO BUILDING AREA

Per IBC Section 506.3 buildings that adjoin or have access to a public way or qualifying green space for more than 25% of their total perimeter are eligible for an area factor increase based on frontage.
To qualify for an area factor increase based on frontage, the public way or open space adjacent to the building perimeter shall have a minimum distance (W) of 20 feet, and only the first 30 feet shall be considered in the calculation. The measurement shall be to the nearest lot line, the entire width of a street, alley or public way, or the exterior face of an adjacent building on the same property.
For purposes of simplifying this calculation only those portions of perimeter fronting right of way or green space with a dimension of 30 feet or more are considered. Those portions of perimeter that front areas that may qualify (are more than 20 feet, but are less than 30 feet) are not included in the frontage calculation.

Frontage Area increase calculation:
 $I_f = [F/P - 0.25]W/30$
 I_f = area of increase due to frontage
 F = Building perimeter that fronts on a public way or open space
 P = Full building perimeter
 W = Width of public way or open space (max of 30')


For Building A
 F = 370.44'
 P = 395.76'
 W = 30'
 $I_f = [370.44/395.76 - 0.25]30/30 = 0.68$ factor of increase due to frontage

ALLOWABLE BUILDING AREA

Per IBC Table 506.2: Buildings of R-2 occupancy with VB construction type are allowed to have an area of 7,000 square feet per floor. With the area factor increase from above this allowable area per floor is increased as follows:
 7,000 s.f. x (7,000 s.f. X 0.68) = **11,802 square feet per floor allowed**

Proposed floor area for Building A

Bsmt:	3,898 s.f.
Floor 1:	7,592 s.f.
Floor 2:	7,550 s.f.
Floor 3:	7,563 s.f.

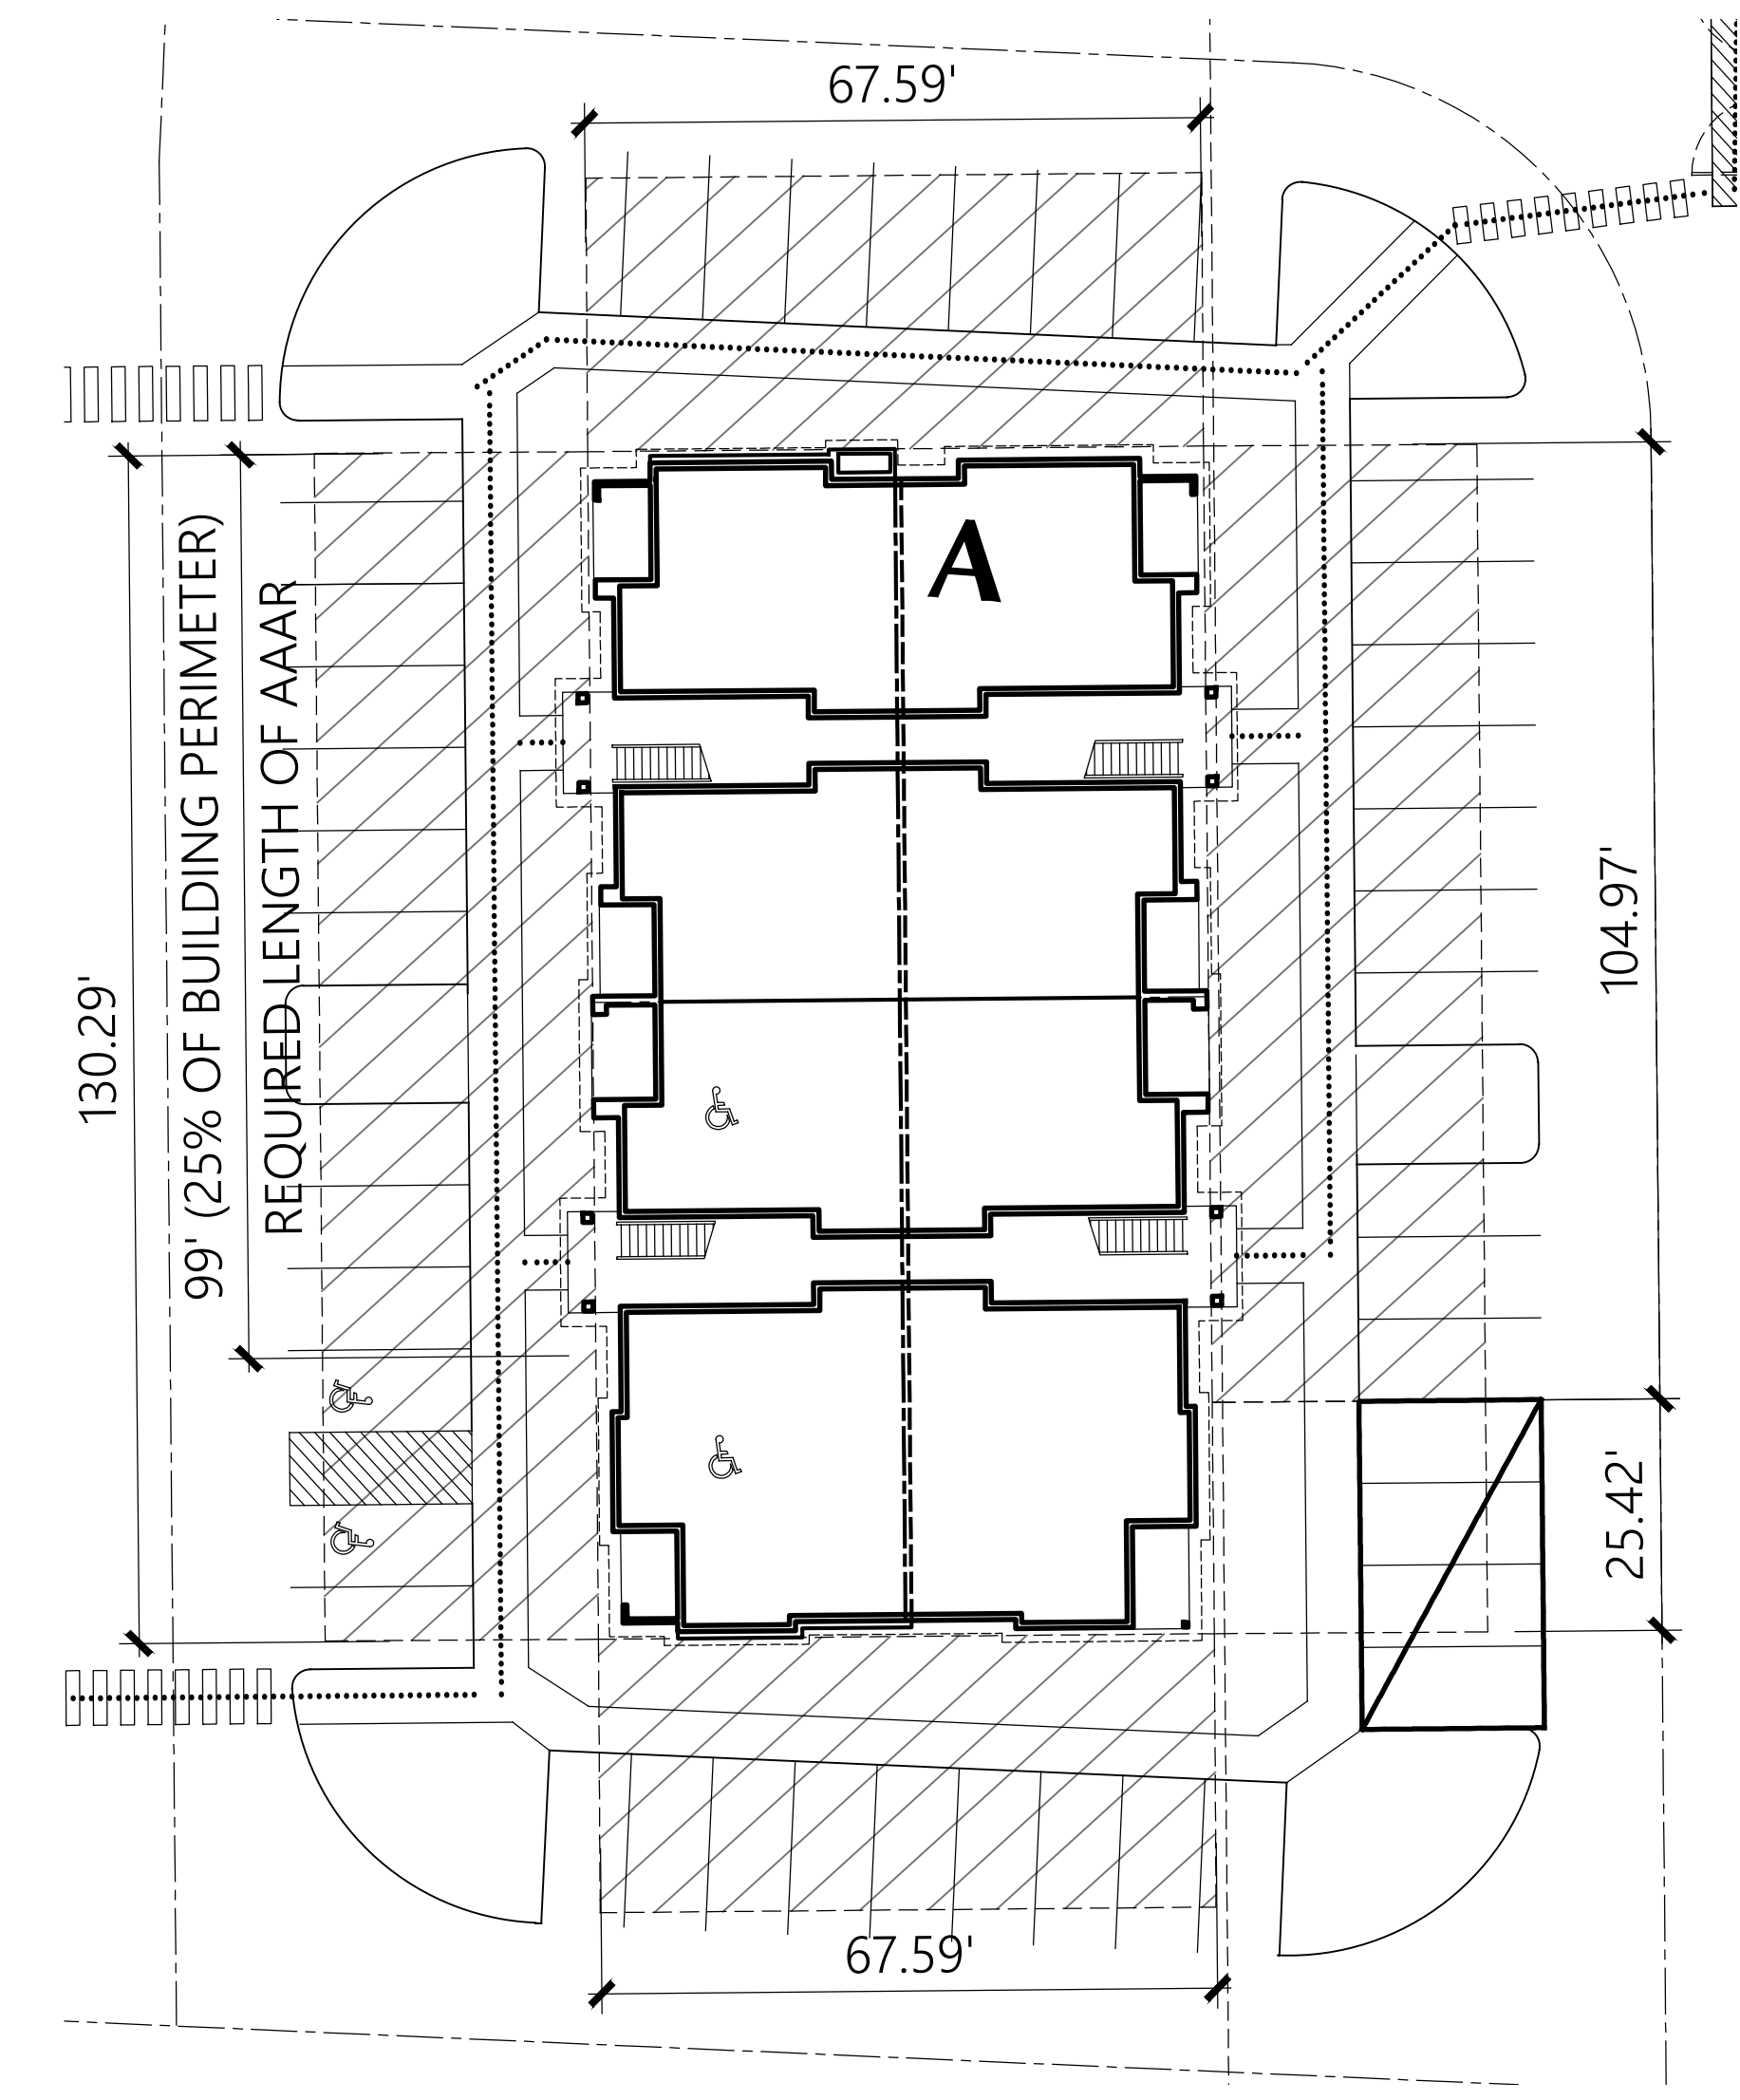

BUILDING A AREA INCREASE DIAGRAM
1" = 20'



Grade Plane Calculations
Building A

Bradley Heights Apartments
Puyallup, Wa

Timberlane Partners

Revisions		
No.	Date	Description

Initial Publish Date:	
Date Plotted:	2-20-24
Job No.:	23-06
Drawn By:	TMK
Sheet No.:	

A5

IBC SECTION 202 DEFINITIONS

BASEMENT: A STORY THAT IS NOT A STORY ABOVE GRADE PLANE (SEE "STORY ABOVE GRADE PLANE"). THIS DEFINITION OF "BASEMENT" DOES NOT APPLY TO THE PROVISIONS OF SECTION 1612 FOR FLOOD LOADS.

STORY ABOVE GRADE PLANE: ANY STORY HAVING ITS FINISHED FLOOR SURFACE ENTIRELY ABOVE GRADE PLANE, OR IN WHICH THE FINISHED SURFACE OF THE FLOOR NEXT ABOVE IS:

- MORE THAN 6 FEET (1829 MM) ABOVE GRADE PLANE; OR
- MORE THAN 12 FEET (3658 MM) ABOVE THE FINISHED GROUND LEVEL AT ANY POINT

GRADE PLANE: A REFERENCE PLANE REPRESENTING THE AVERAGE OF FINISHED GROUND LEVEL ADJOINING THE BUILDING AT EXTERIOR WALLS. WHERE THE FINISHED GROUND LEVEL SLOPES AWAY FROM THE EXTERIOR WALLS, THE REFERENCE PLANE SHALL BE ESTABLISHED BY THE LOWEST POINTS WITHIN THE AREA BETWEEN THE BUILDING AND THE LOT LINE OR, WHERE THE LOT LINE IS MORE THAN 6 FEET (1829 MM) FROM THE BUILDING, BETWEEN THE BUILDING AND A POINT 6 FEET (1829 MM) FROM THE BUILDING.

BUILDING A

AVERAGE GRADE ELEVATION AT EACH EXTERIOR WALL:


SEGMENT 1:	
POINT A	= 415.58
POINT B	= 411.55
POINT C	= 420.45
POINT D	= 416.38
$1663.96/4 = 415.99$ AEG	

FIRST FLOOR (FLOOR NEXT ABOVE GRADE PLANE) IS LESS THAN 6- FEET (ACTUAL 5.72 FEET) BELOW FIRST FLOOR FINISHED FLOOR ELEVATION OF 422.12.


SEGMENT 2:	
POINT D	= 416.38
POINT E	= 414.05
POINT F	= 422.95
POINT G	= 419.76
$1673.14/4 = 418.30$ AEG	


FIRST FLOOR (FLOOR NEXT ABOVE GRADE PLANE) IS LESS THAN 6- FEET (ACTUAL 5.29 FEET) BELOW FIRST FLOOR FINISHED FLOOR ELEVATION OF 424.62.

BUILDING A QUALIFIES AS 3-STORY OVER BASEMENT

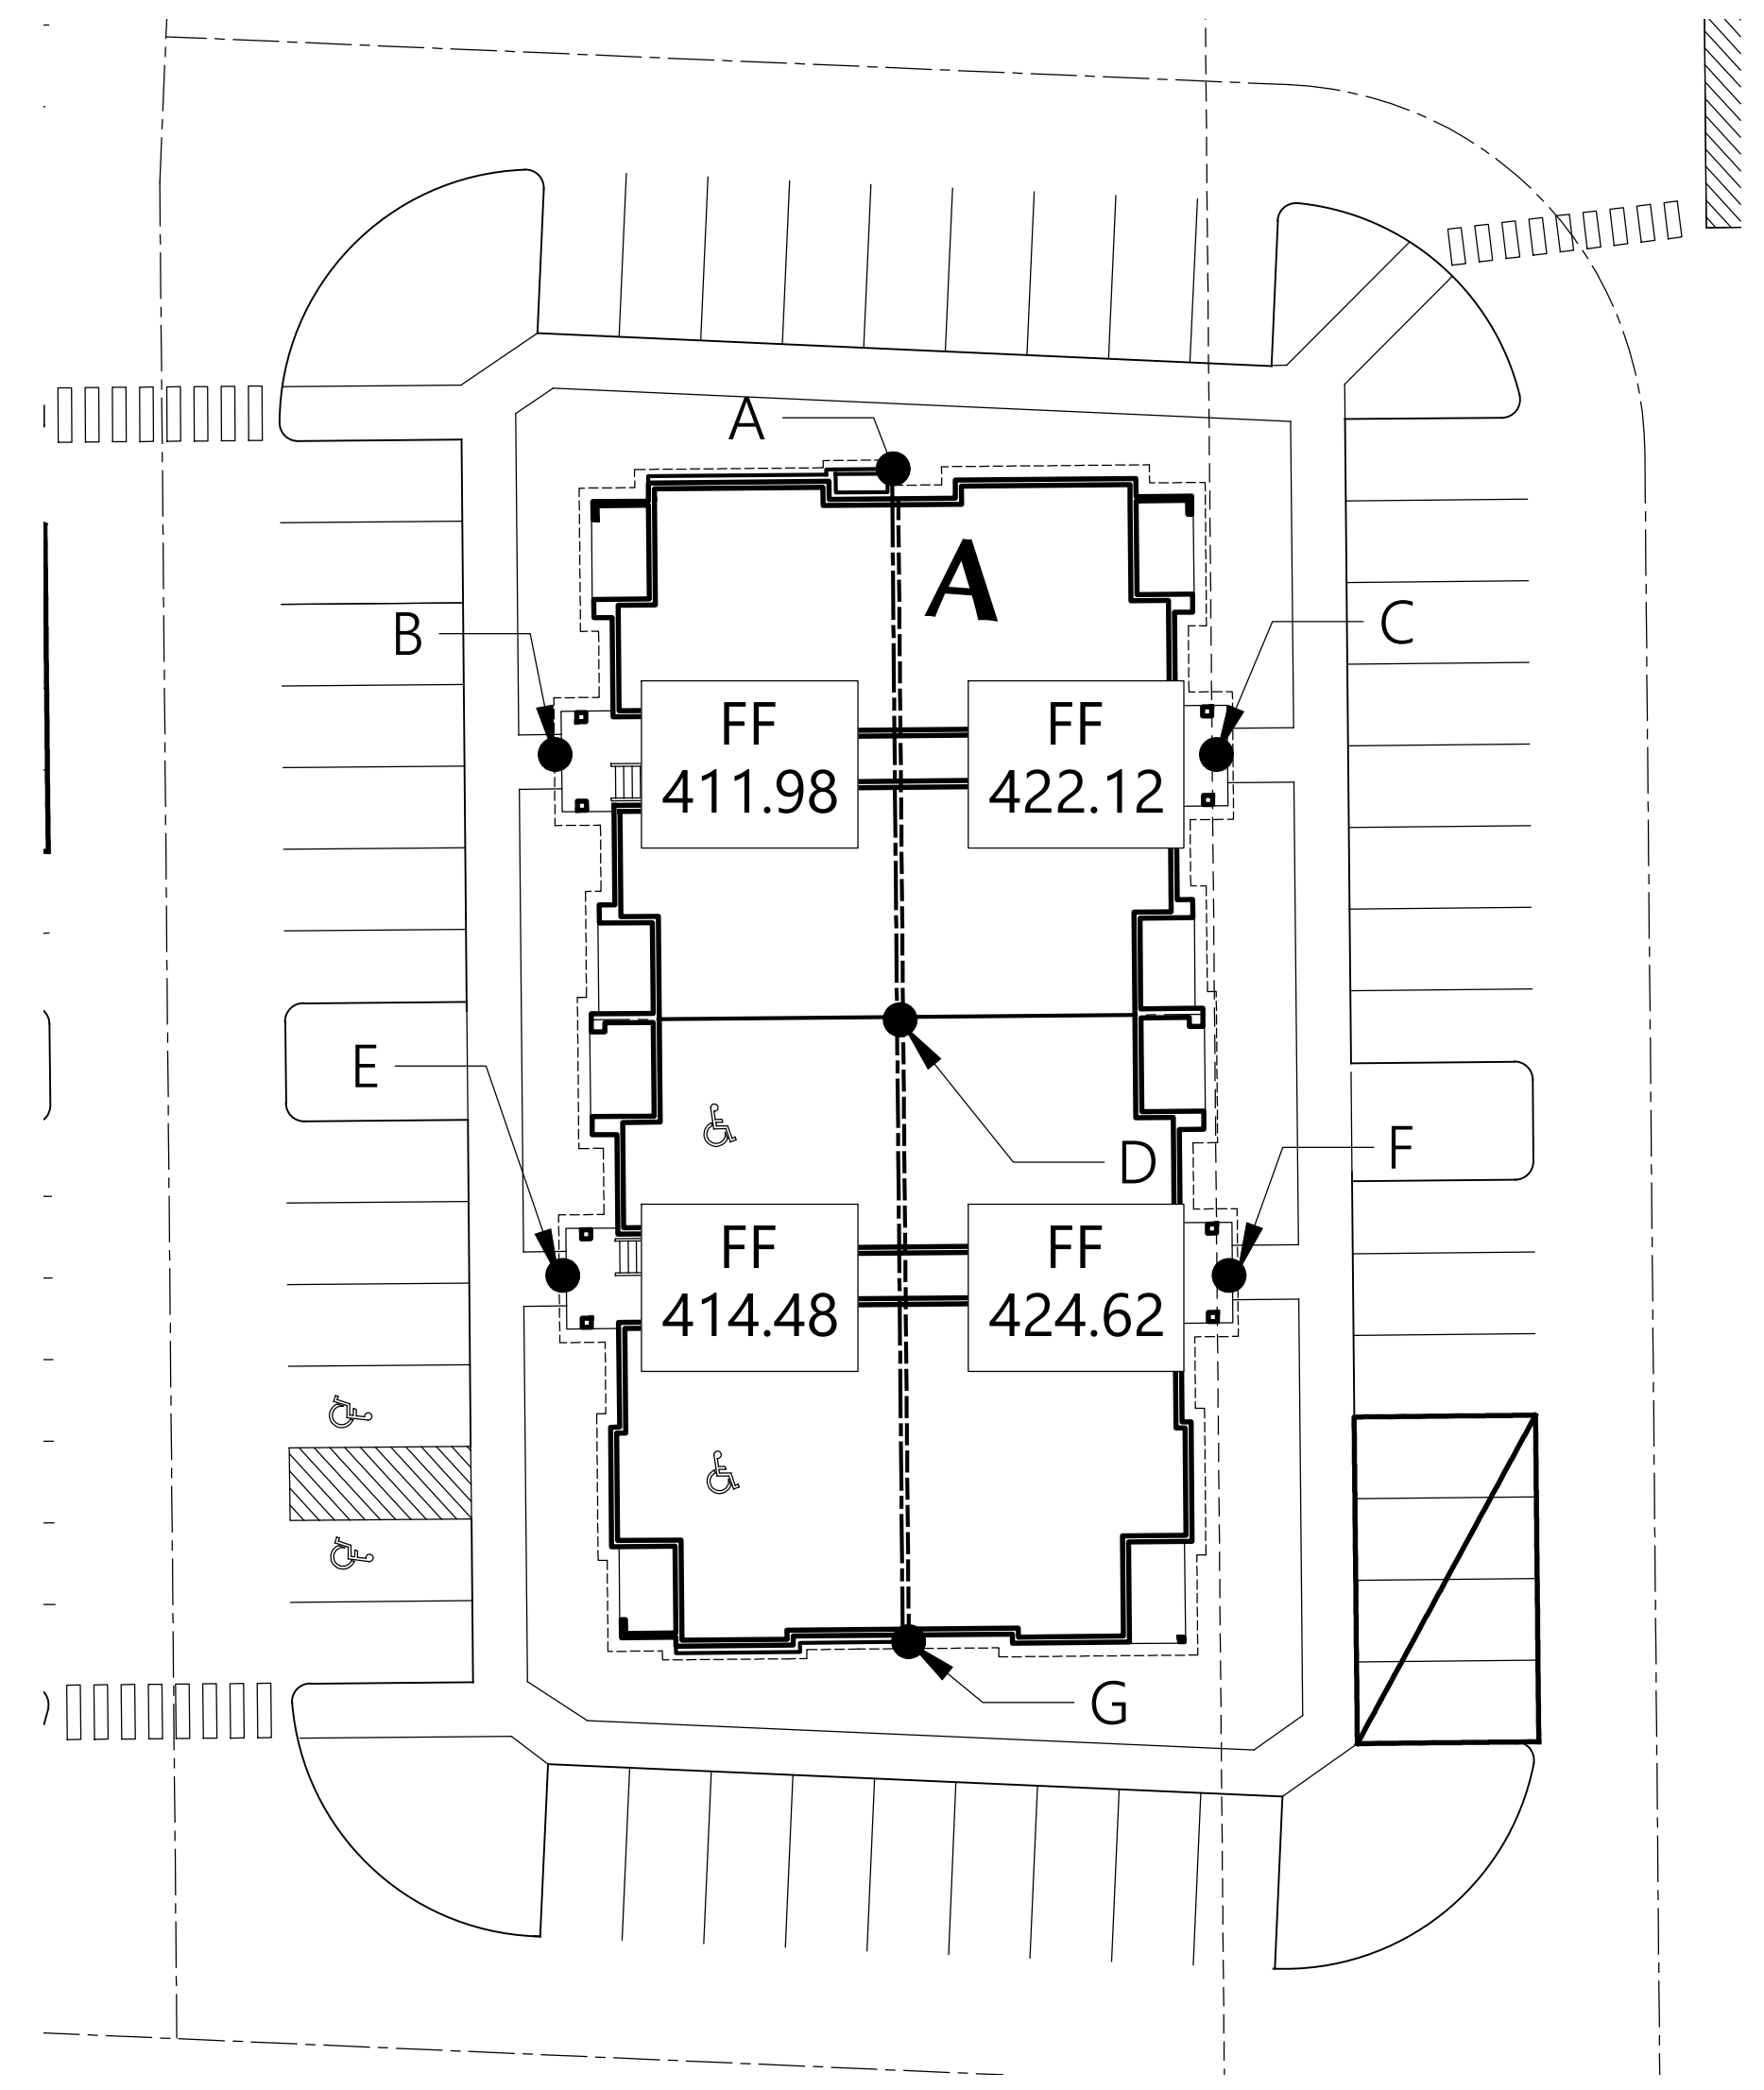


BUILDING A GRADE PLANE CALCULATIONS
1" = 20'



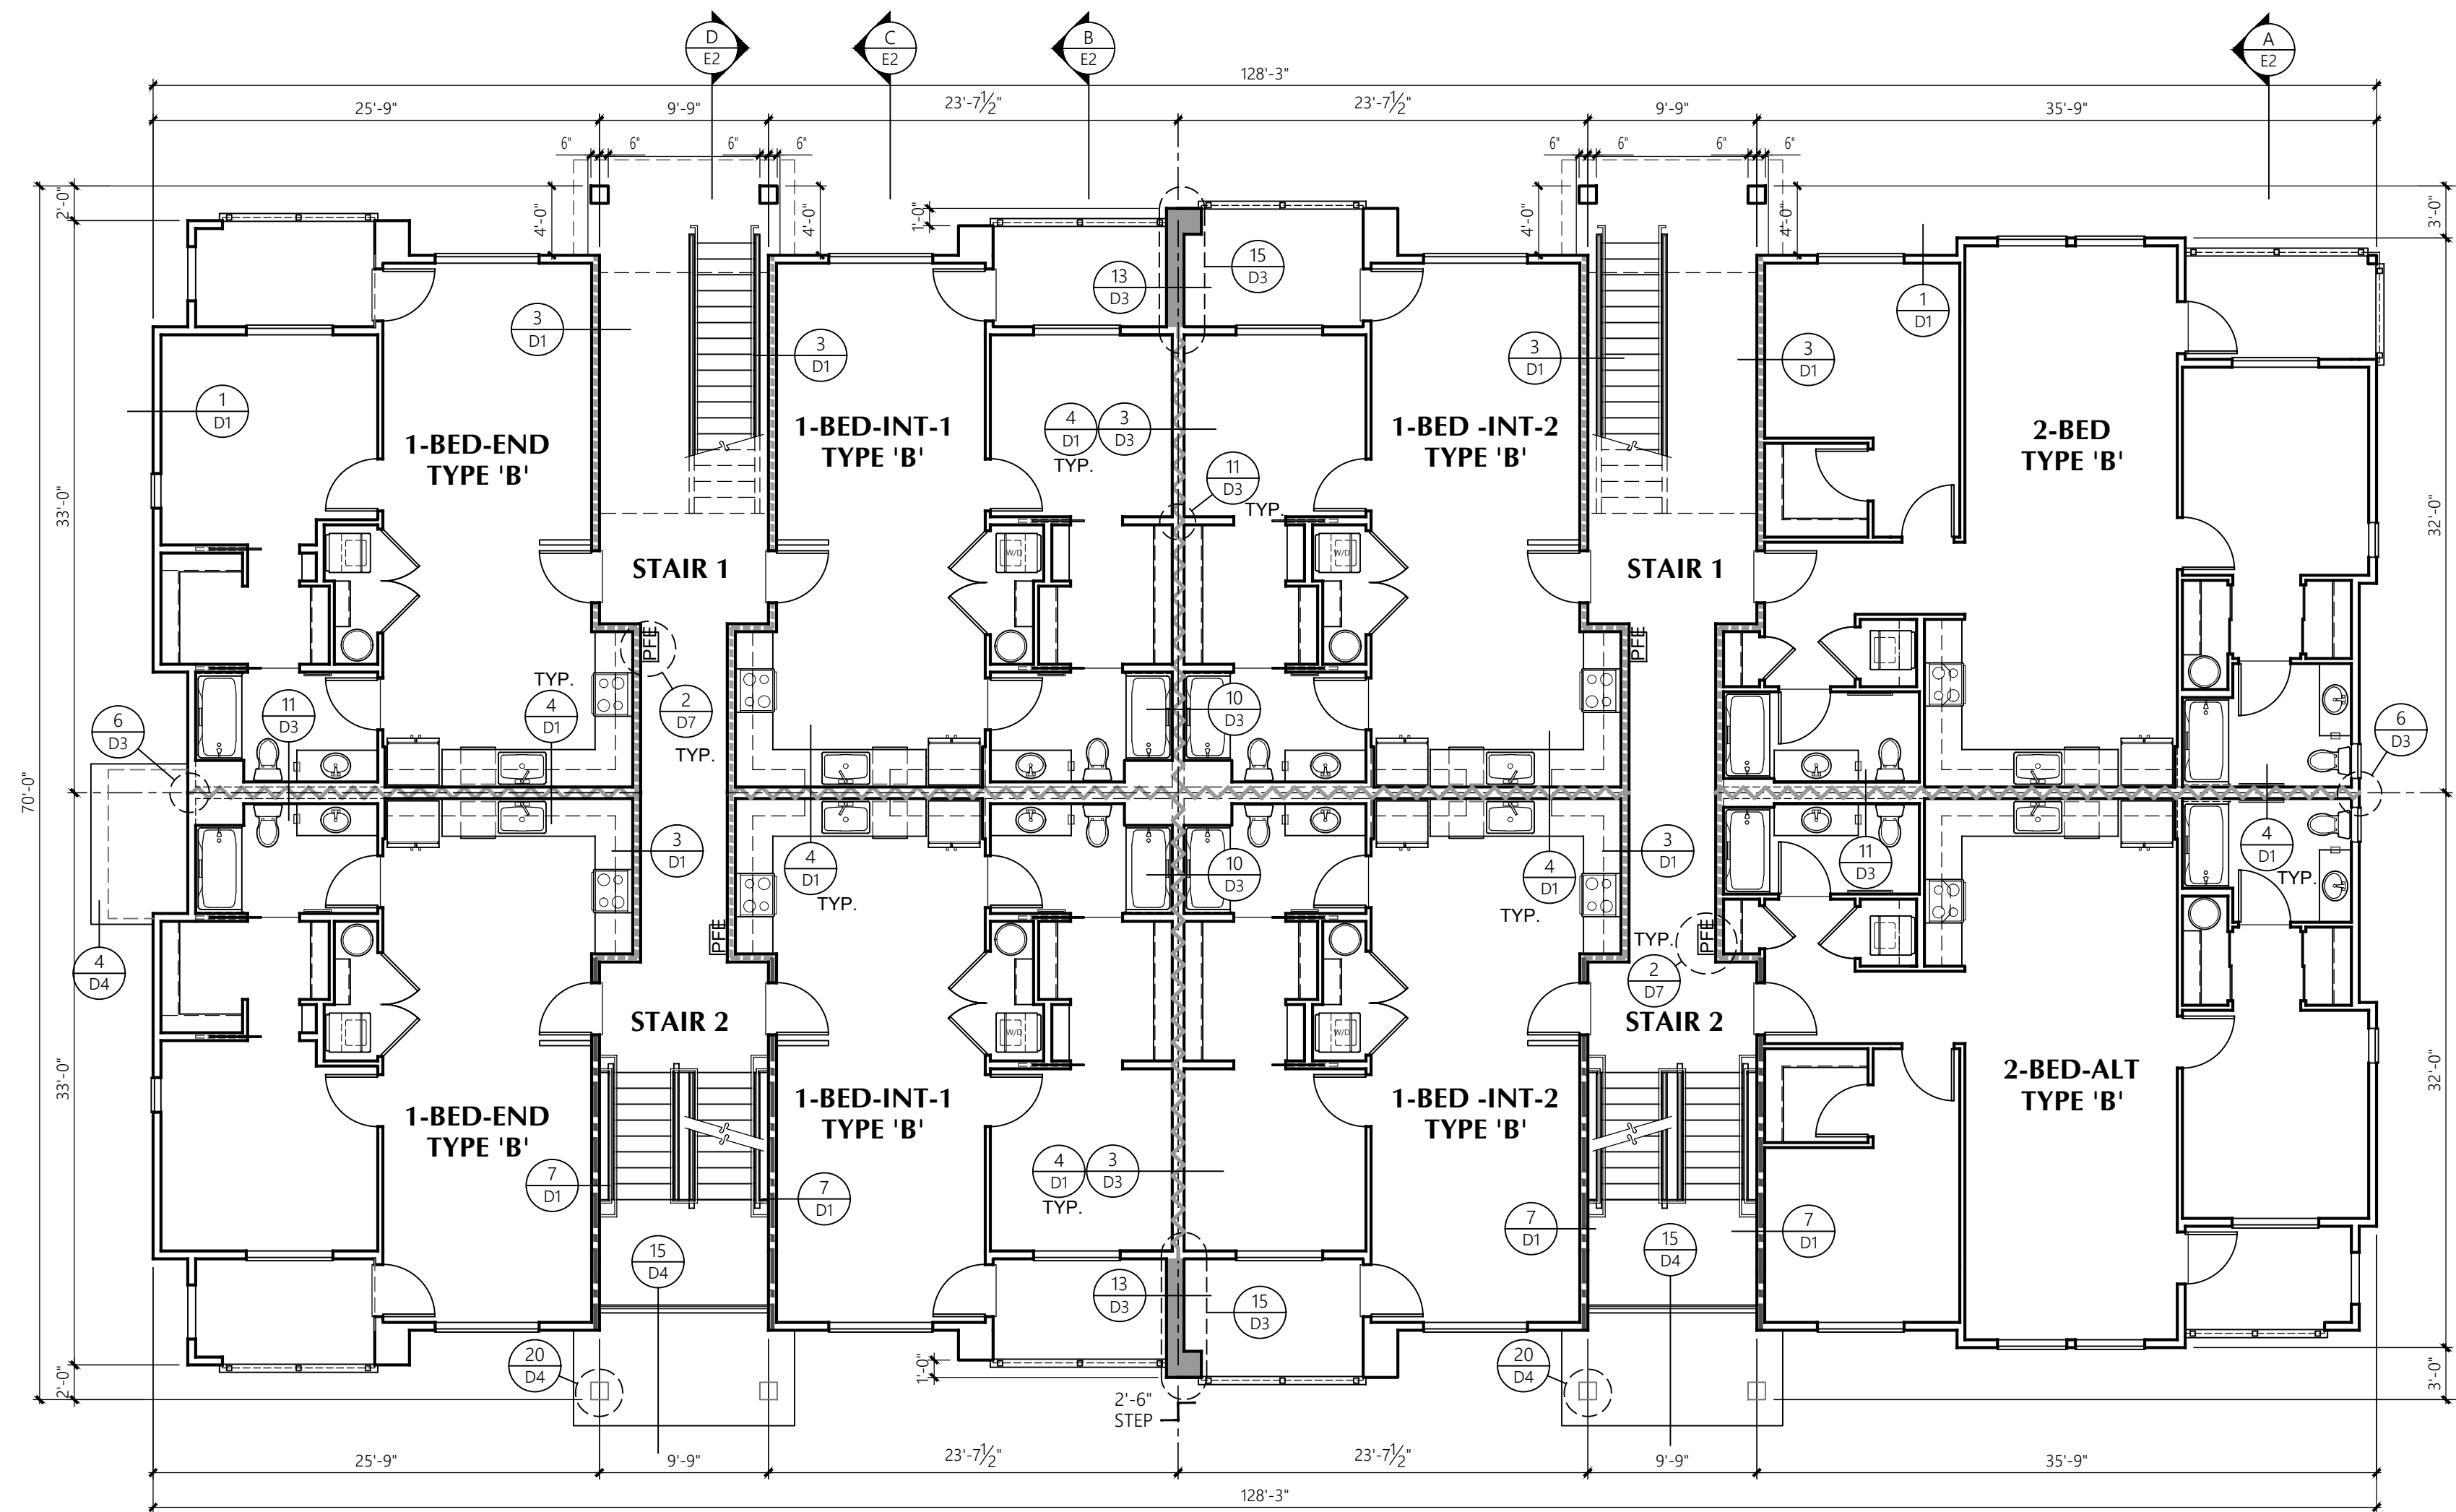

BUILDING A 1st LEVEL PLAN
 1/8" = 1'-0" 3/4 SPLIT LEVEL, 28-UNIT BUILDING

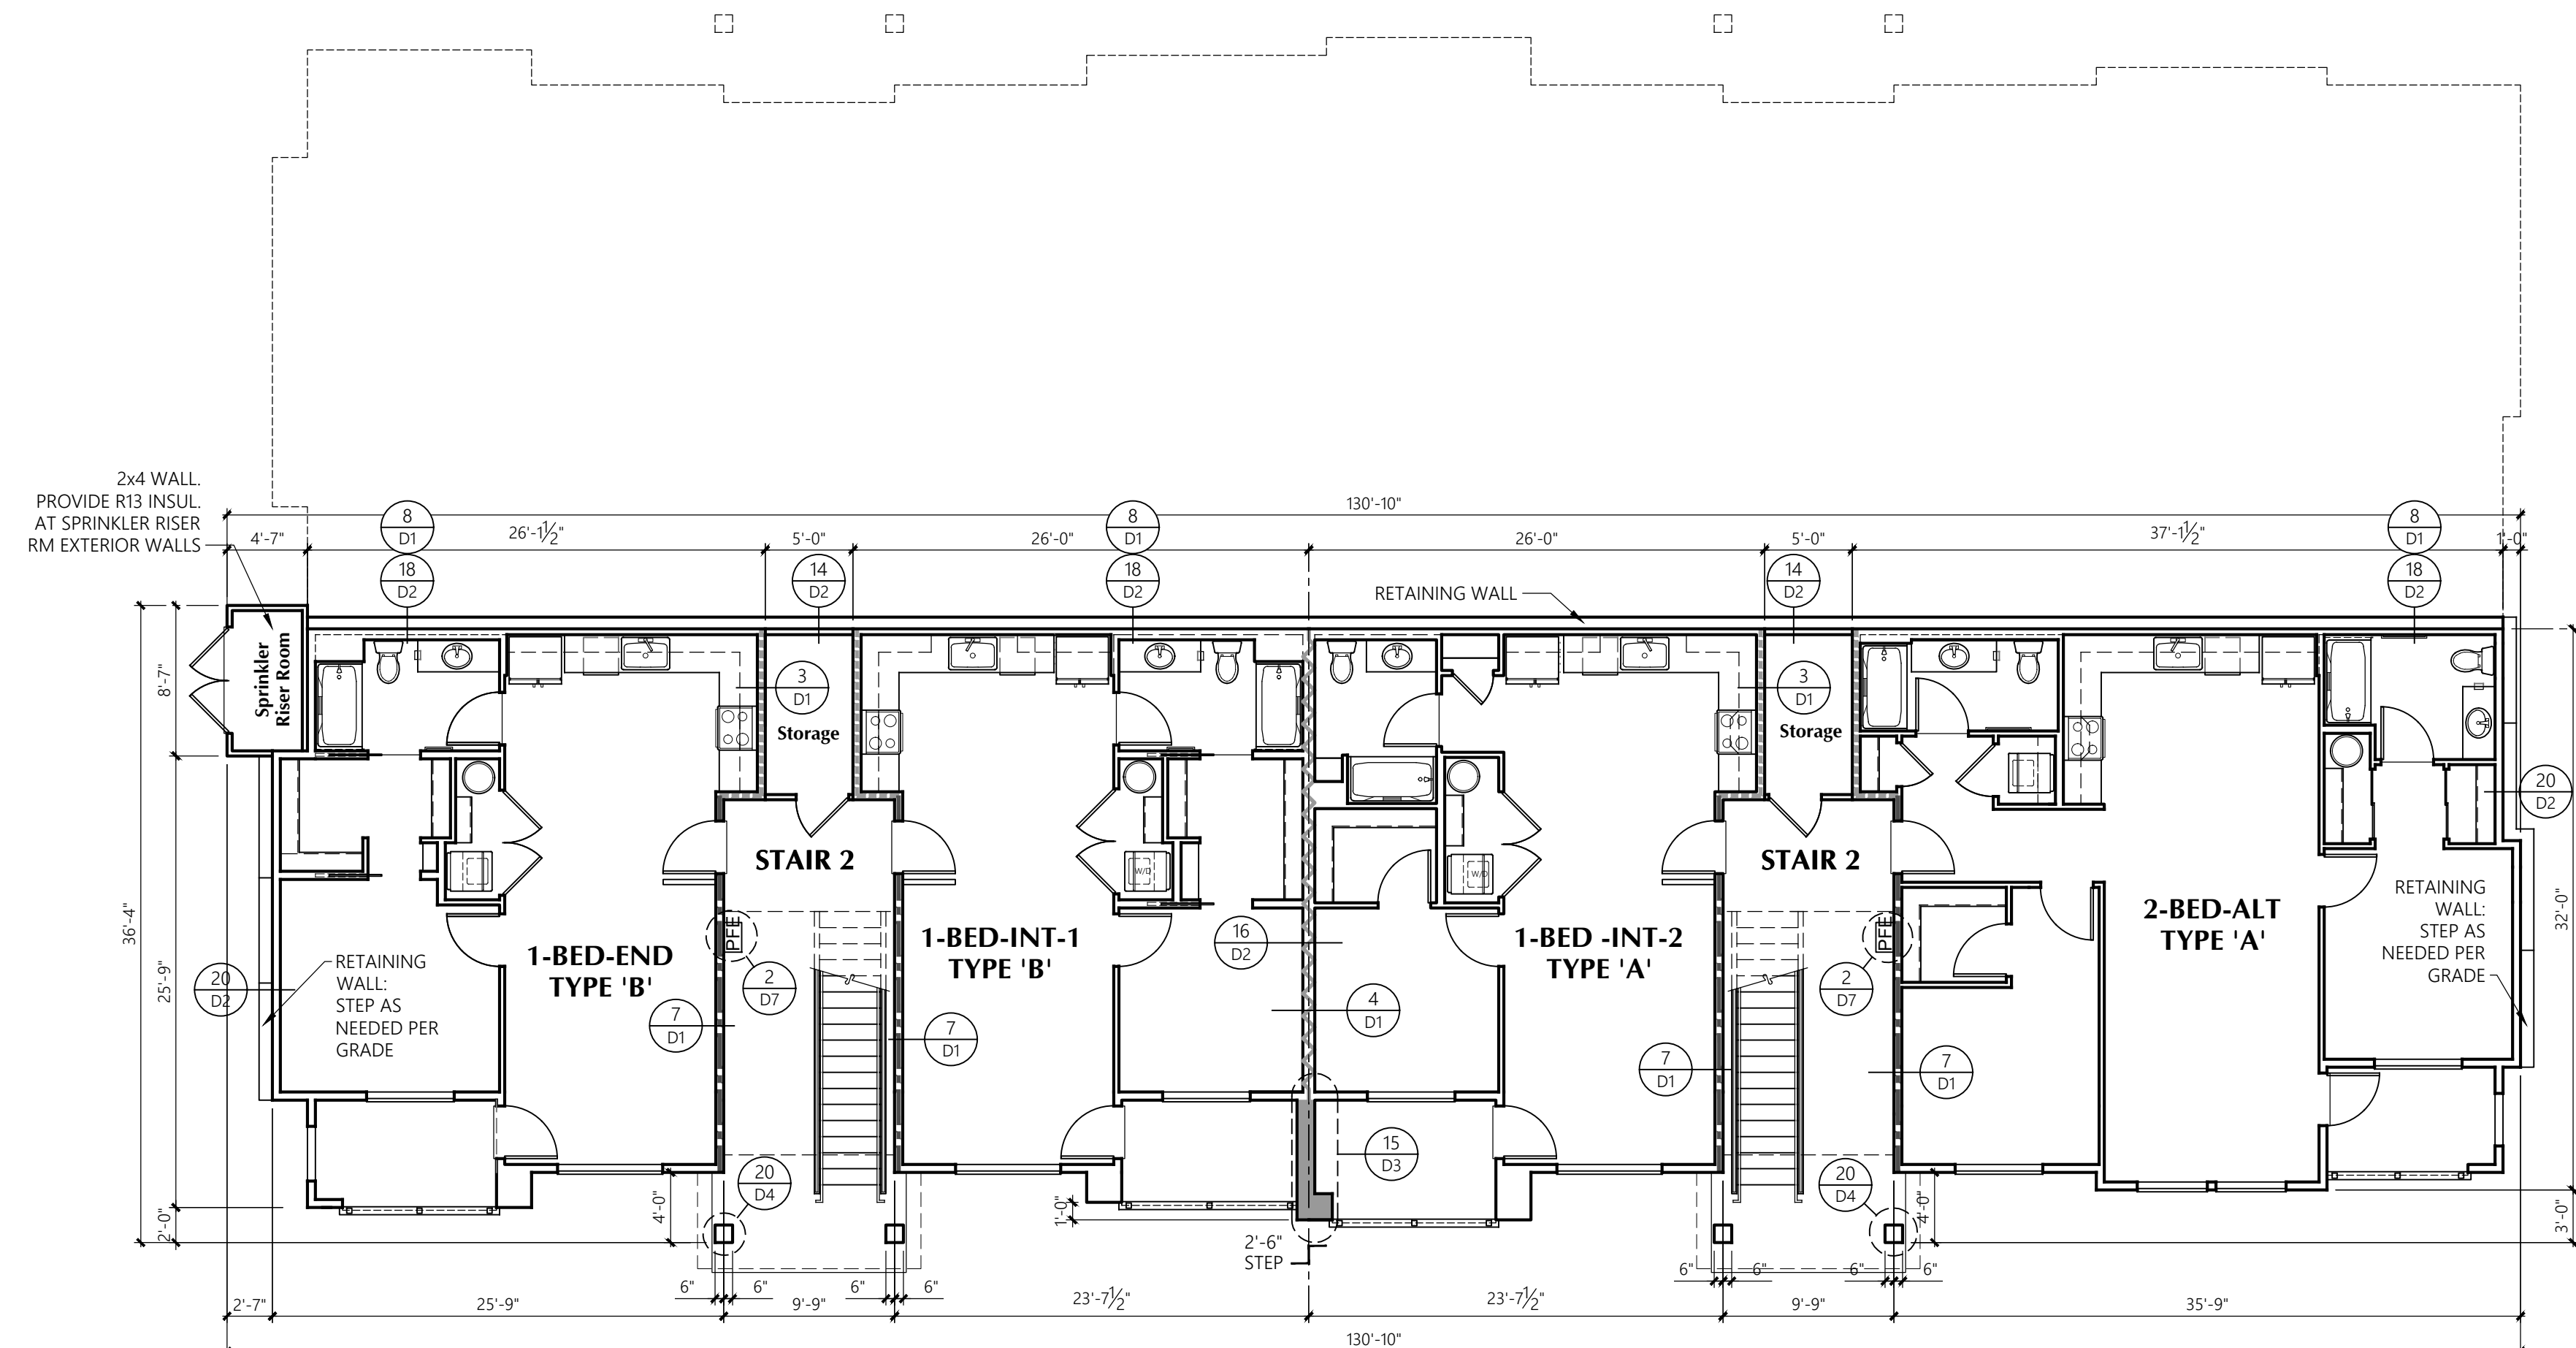


BUILDING A BASEMENT LEVEL PLAN
 1/8" = 1'-0" 3/4 SPLIT LEVEL, 28-UNIT BUILDING


LEGEND

- EXTENT OF 1-HR FIRE PARTITION
- 1-HR FIRE PARTITION SEPARATES THE INTERIOR SPACES BETWEEN UNITS IN THE SAME BUILDINGS. IT'S EXTENT ENDS WHERE ONE SIDE WOULD BE AN EXTERIOR FACE. SEE 4/D1
- EXTENT OF 1-HR FIRE BARRIER AROUND EXIT STAIRS. SEE 3/D1
- EXTENT OF 2-HR FIRE BARRIER AROUND EXIT STAIRS. SEE 7/D1
- EXTENT OF 1-HR EXTERIOR WALL. SEE LOCATION SPECIFIC DETAIL
- FE* - SEMI RECESSED FIRE EXTINGUISHER CABINET/SEE DETAIL 2/D7

No.	Date	Description

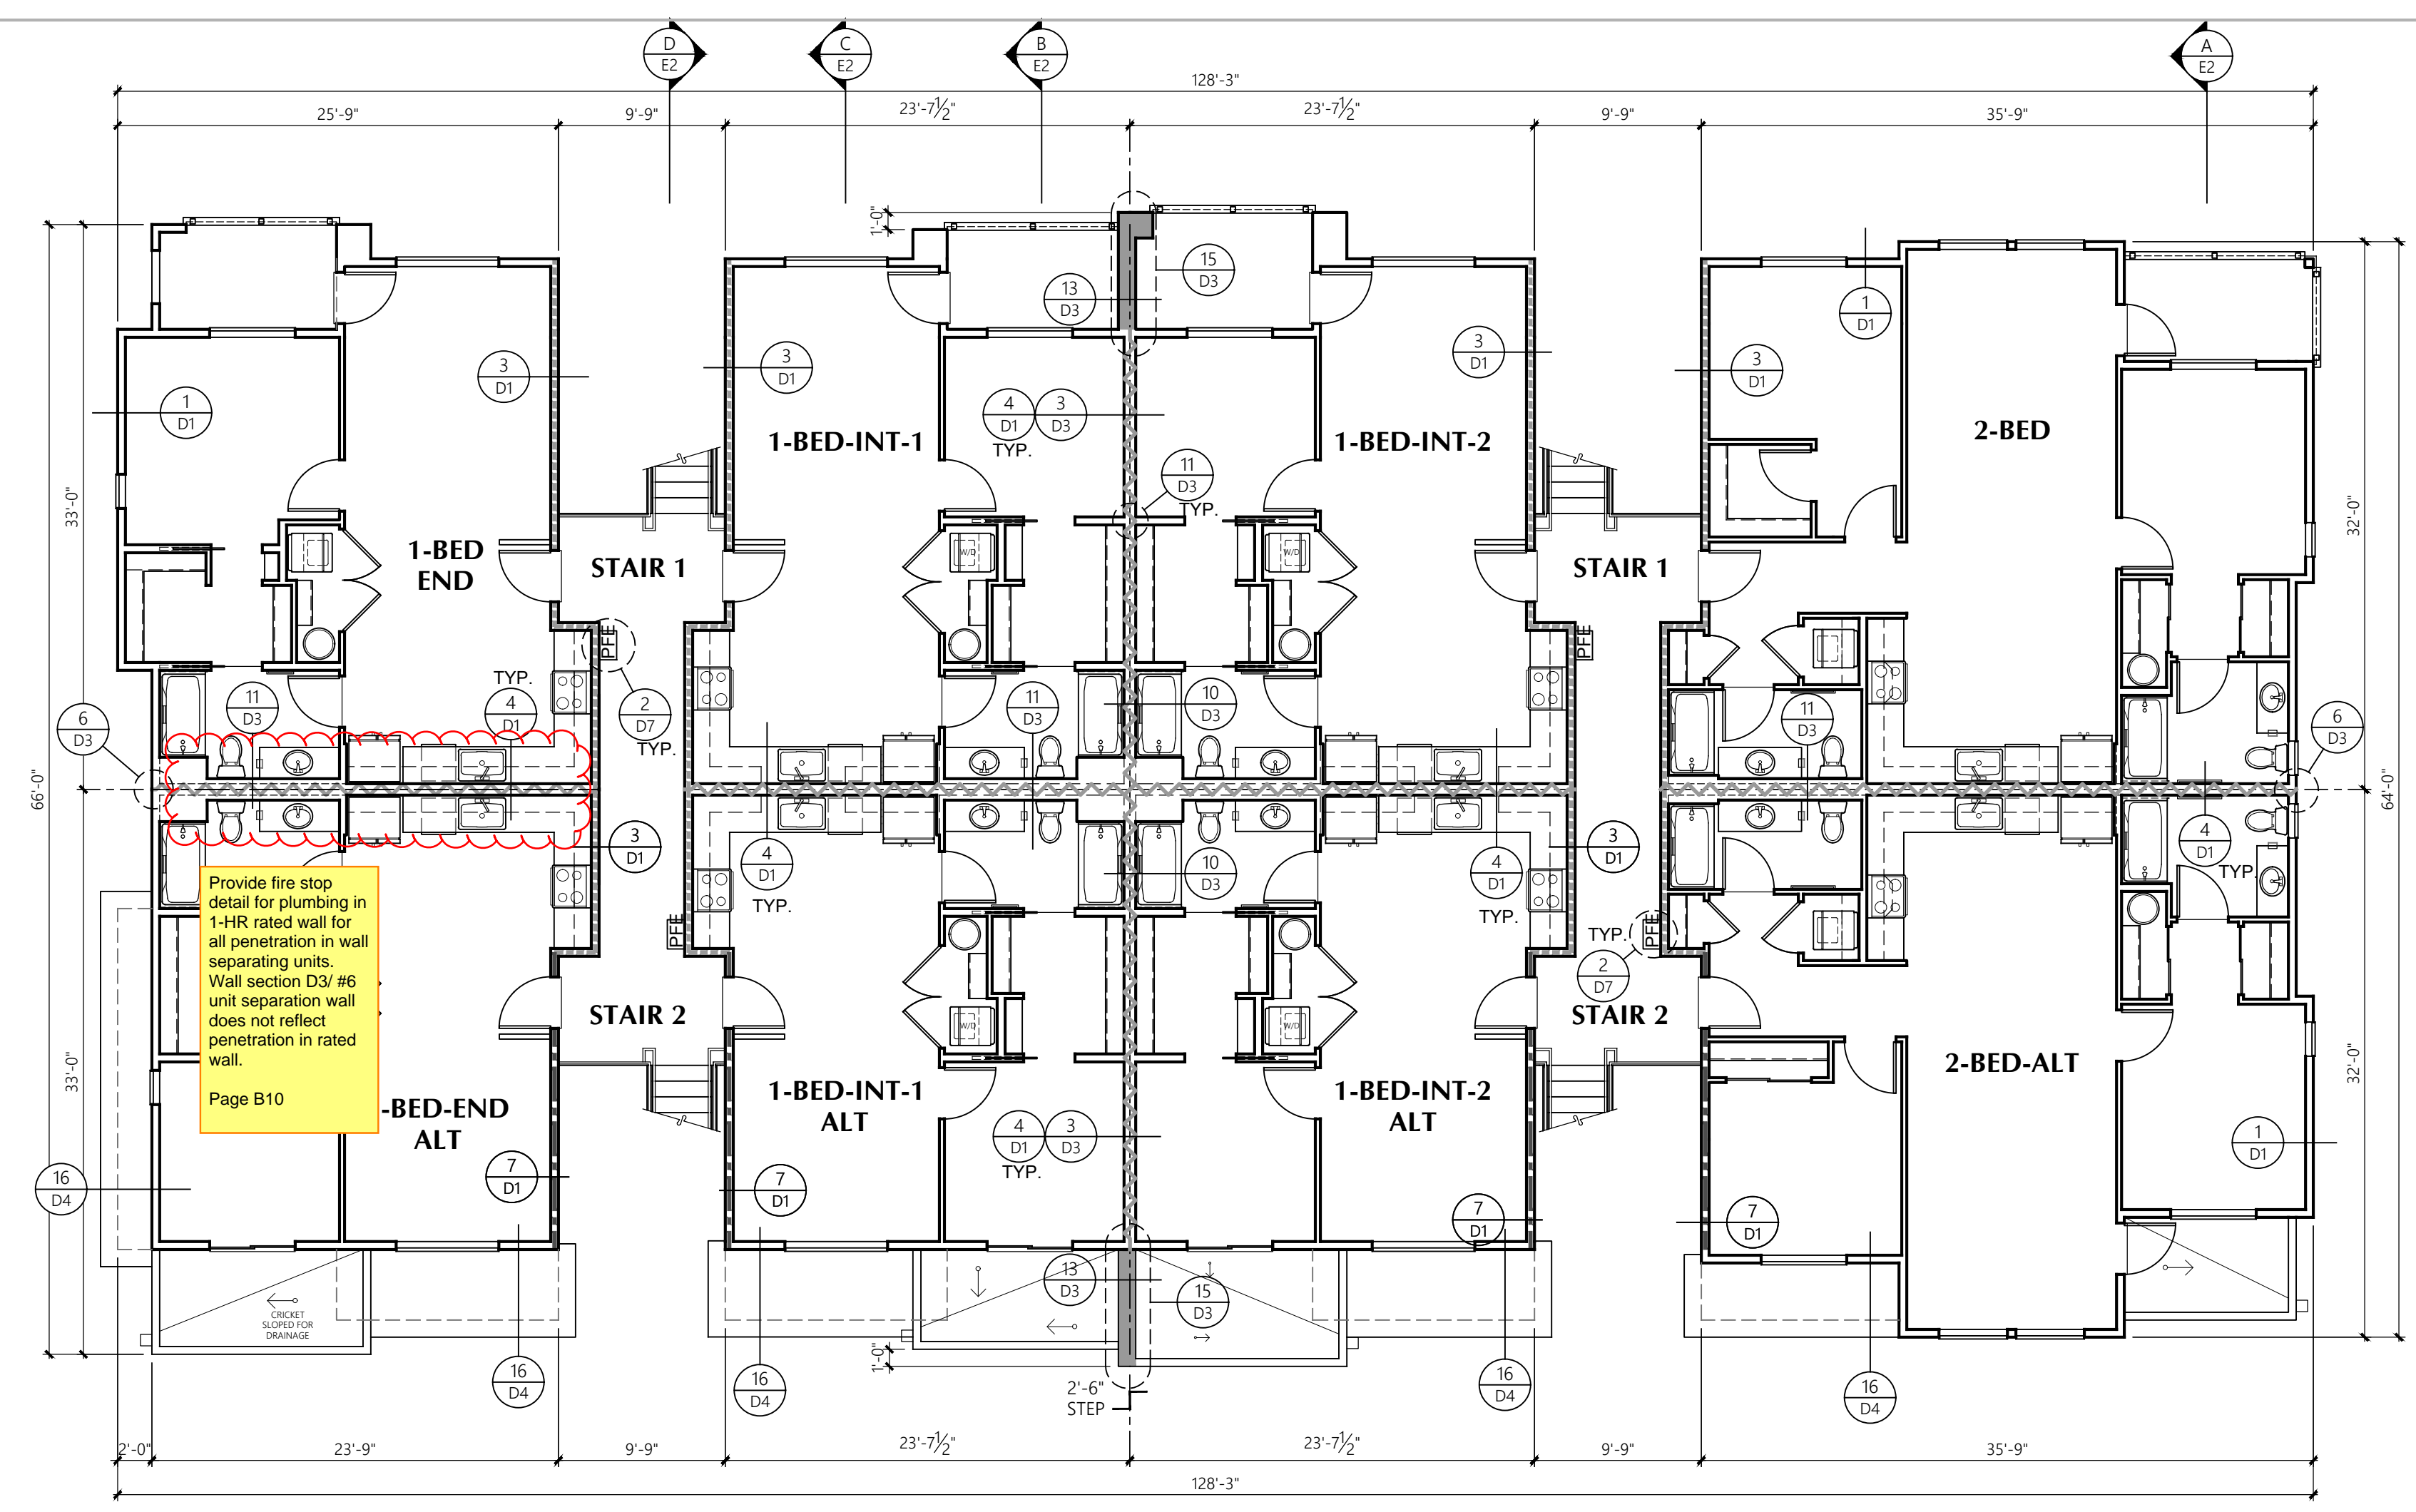


BUILDING A 3rd LEVEL PLAN
1/8" = 1'-0" 3/4 SPLIT LEVEL, 28-UNIT BUILDING

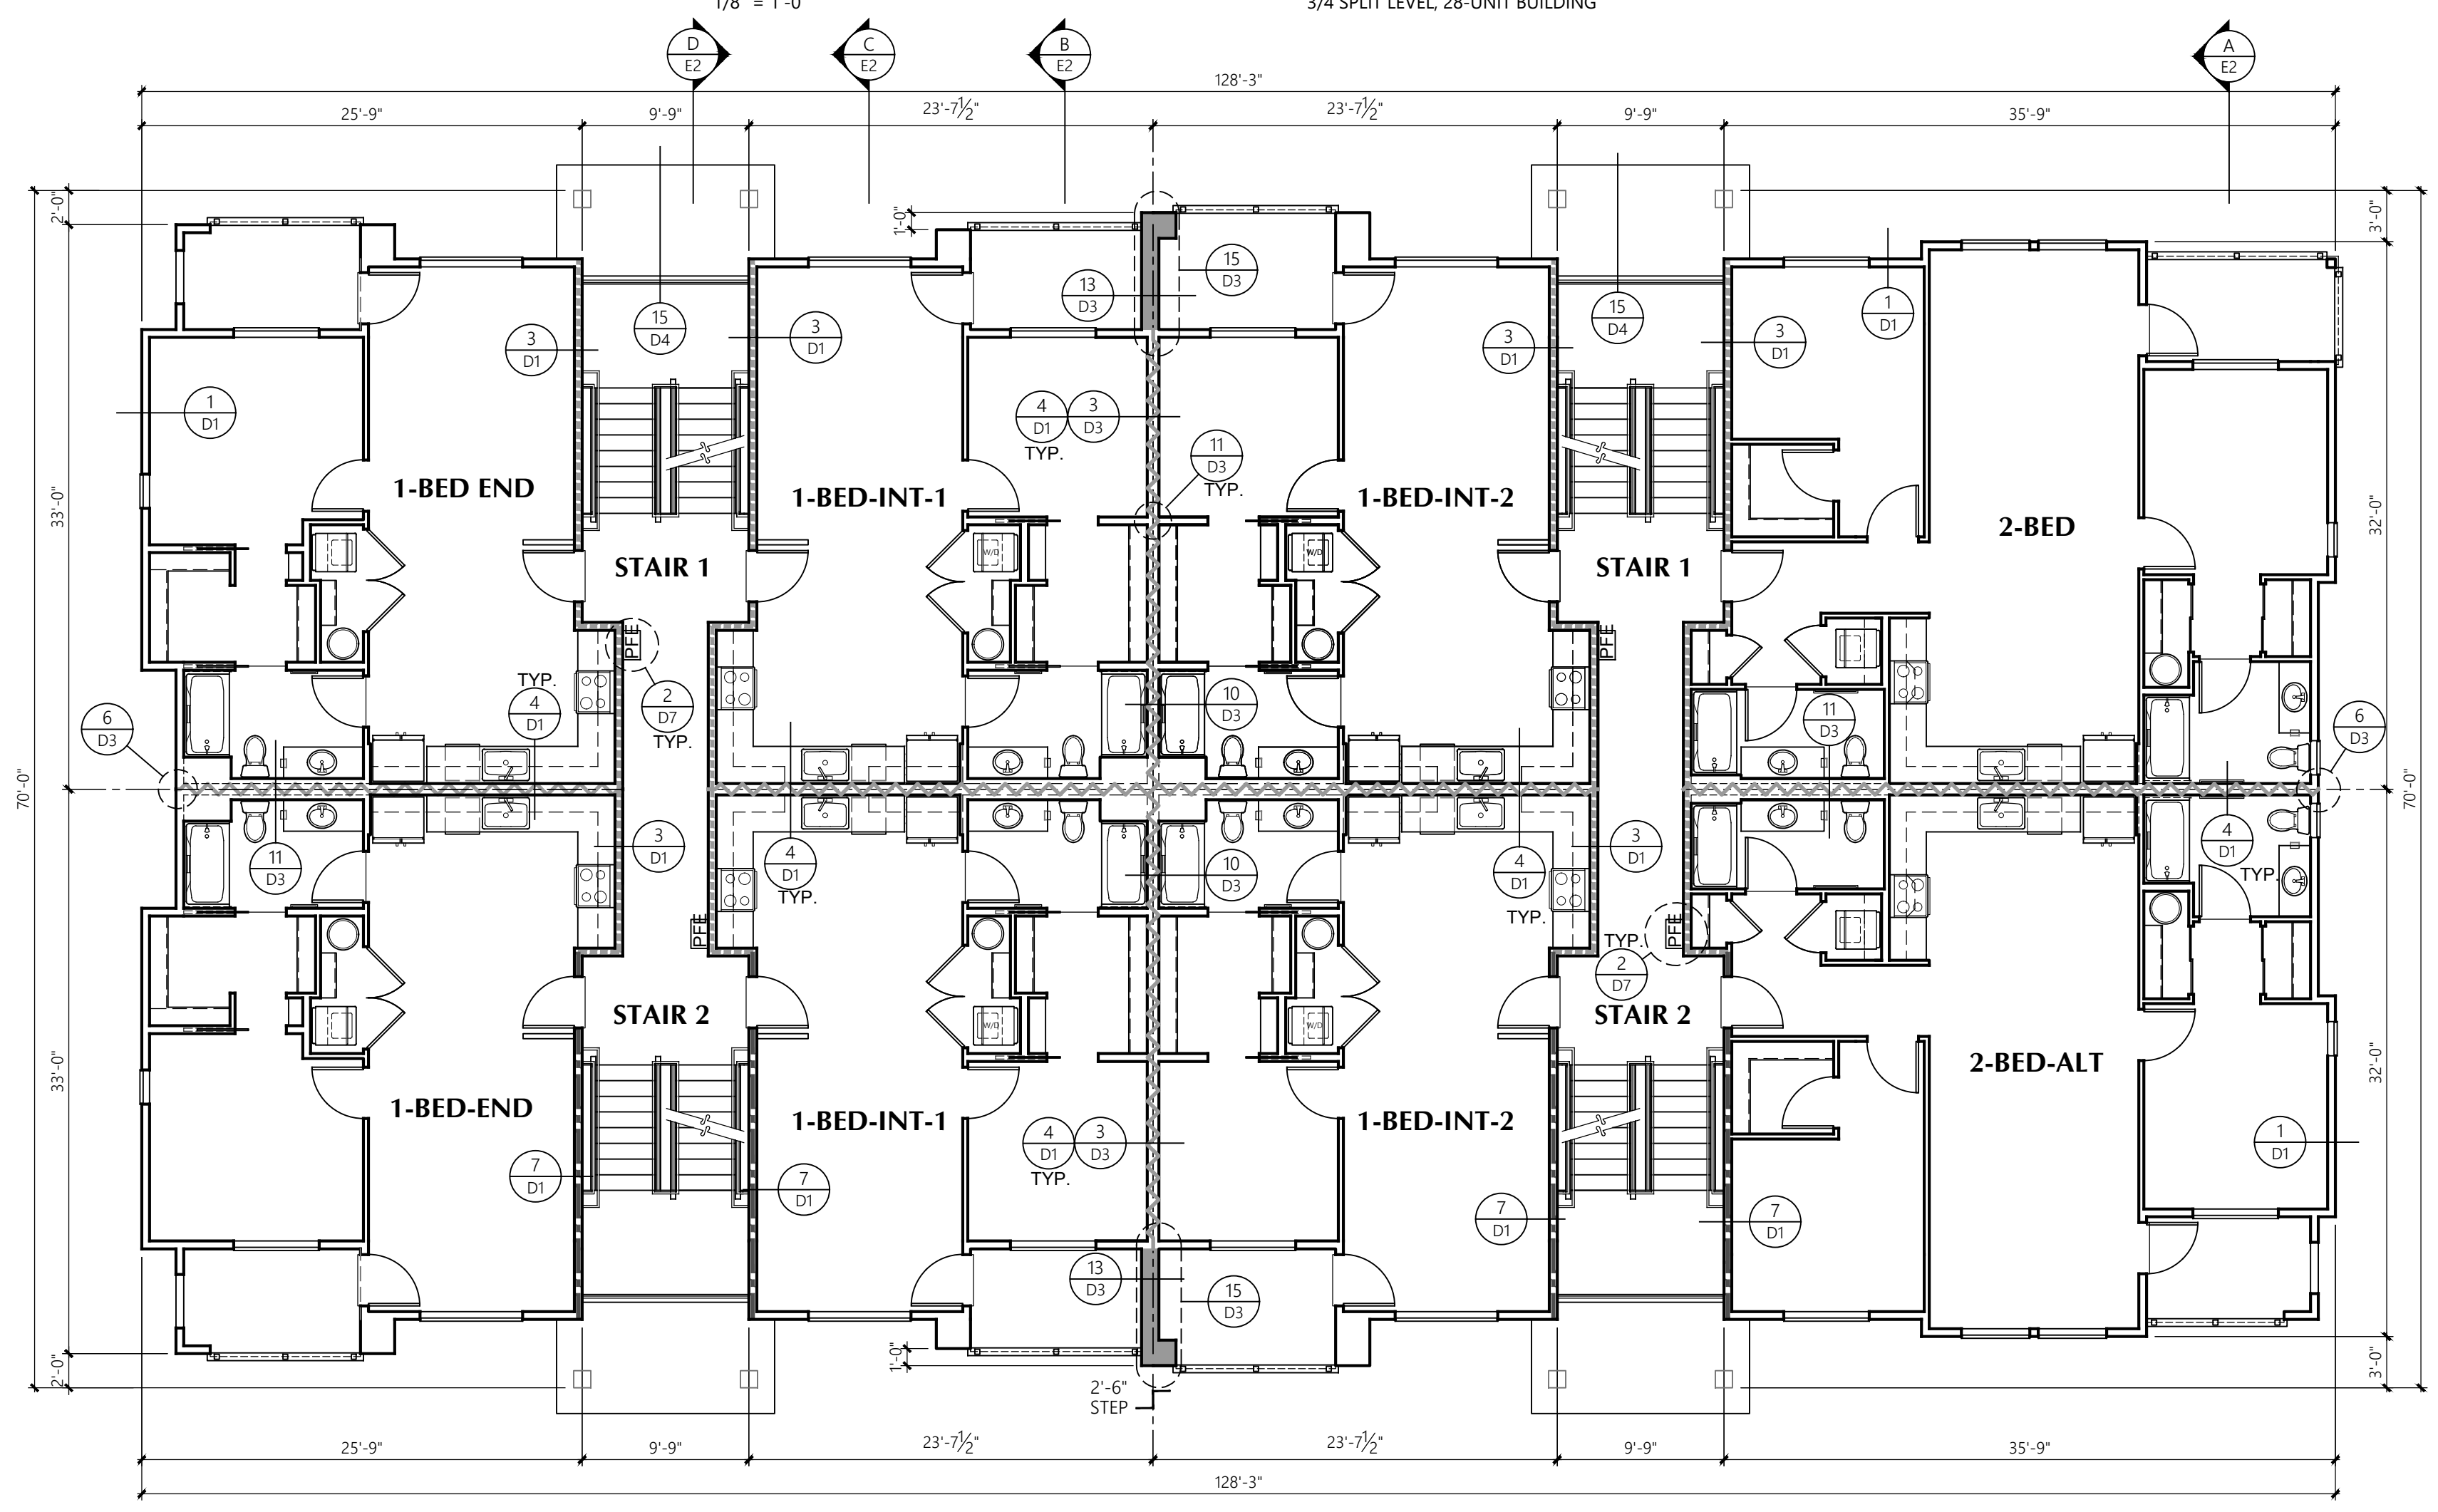

BUILDING A 2nd LEVEL PLAN
1/8" = 1'-0" 3/4 SPLIT LEVEL, 28-UNIT BUILDING

LEGEND


- EXTENT OF 1-HR FIRE PARTITION
- 1-HR FIRE BARRIER SEPARATES THE INTERIOR SPACES BETWEEN UNITS IN THE SAME BUILDINGS. IT'S EXTENT ENDS WHERE ONE SIDE WOULD BE AN EXTERIOR FACE. SEE 4/D1
- EXTENT OF 1-HR FIRE BARRIER AROUND EXIT STAIRS, SEE 3/D1
- EXTENT OF 2-HR FIRE BARRIER AROUND EXIT STAIRS, SEE 7/D1
- EXTENT OF 1-HR EXTERIOR WALL, SEE LOCATION SPECIFIC DETAIL
- FE* - SEMI RECESSED FIRE EXTINGUISHER CABINET/SEE DETAIL 2/D7

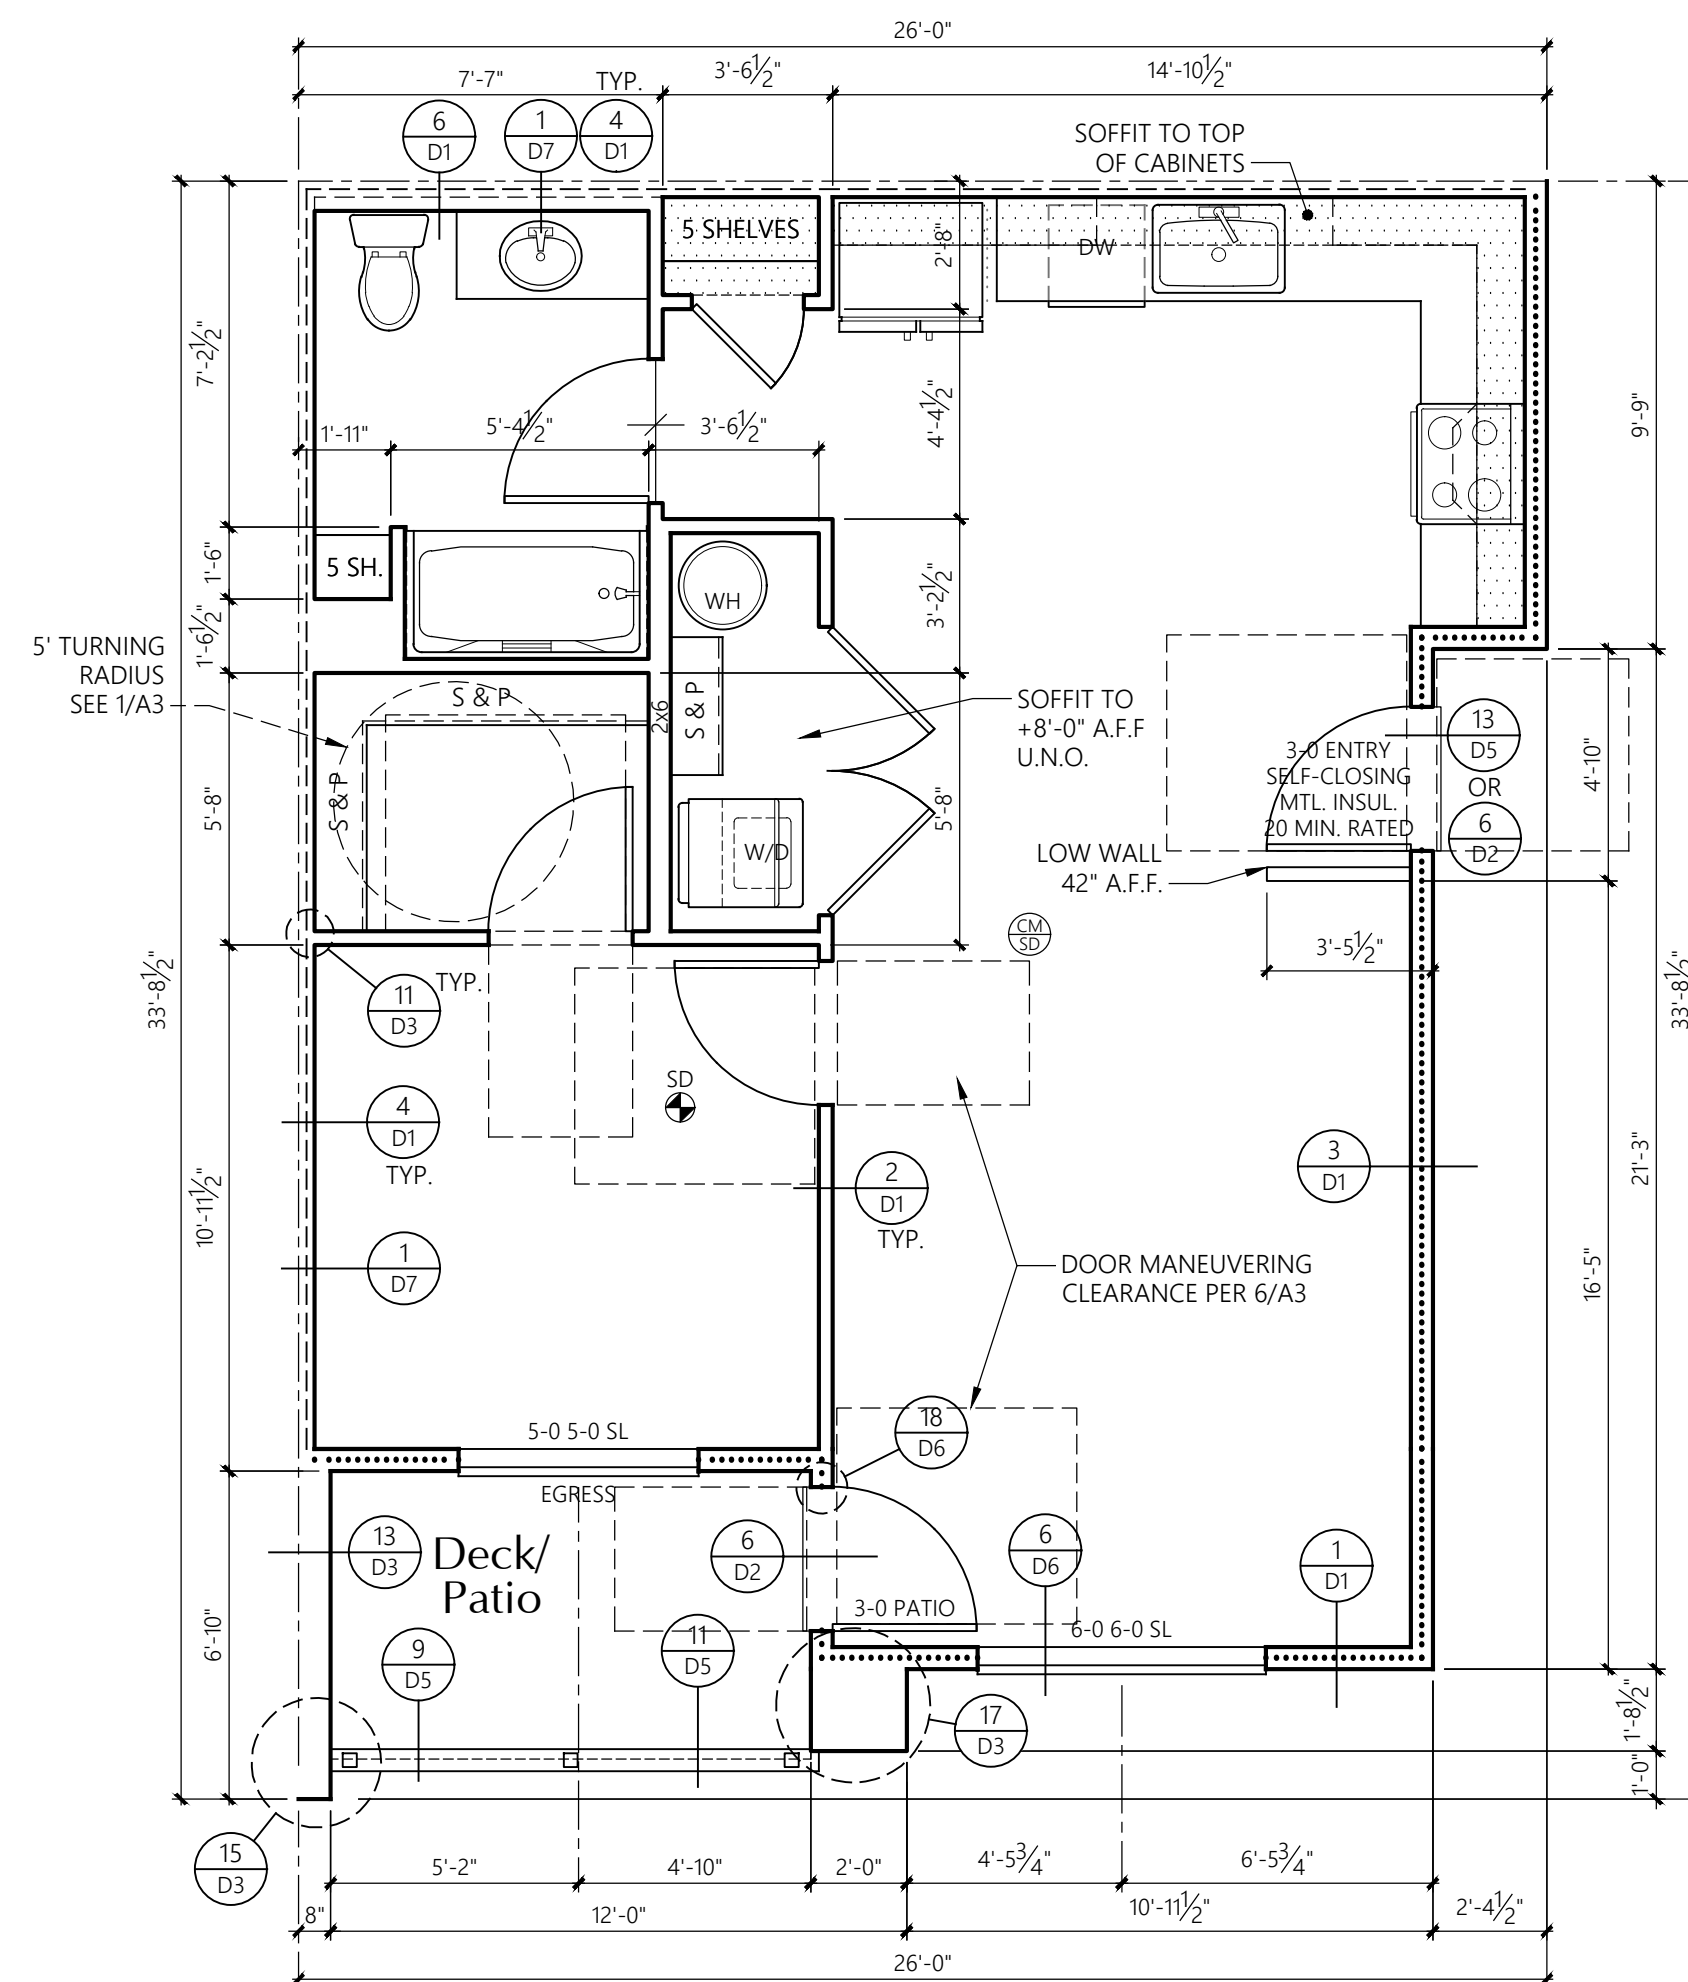

1-BED-INT-1 UNIT TYPE 'A' ACCESSIBLE
BASEMENT & 1st LEVEL FLOOR PLAN

1/4" = 1'-0"

AREA SUMMARY		
Total SF	Heated SF	Patio/Deck SF
61	684	61

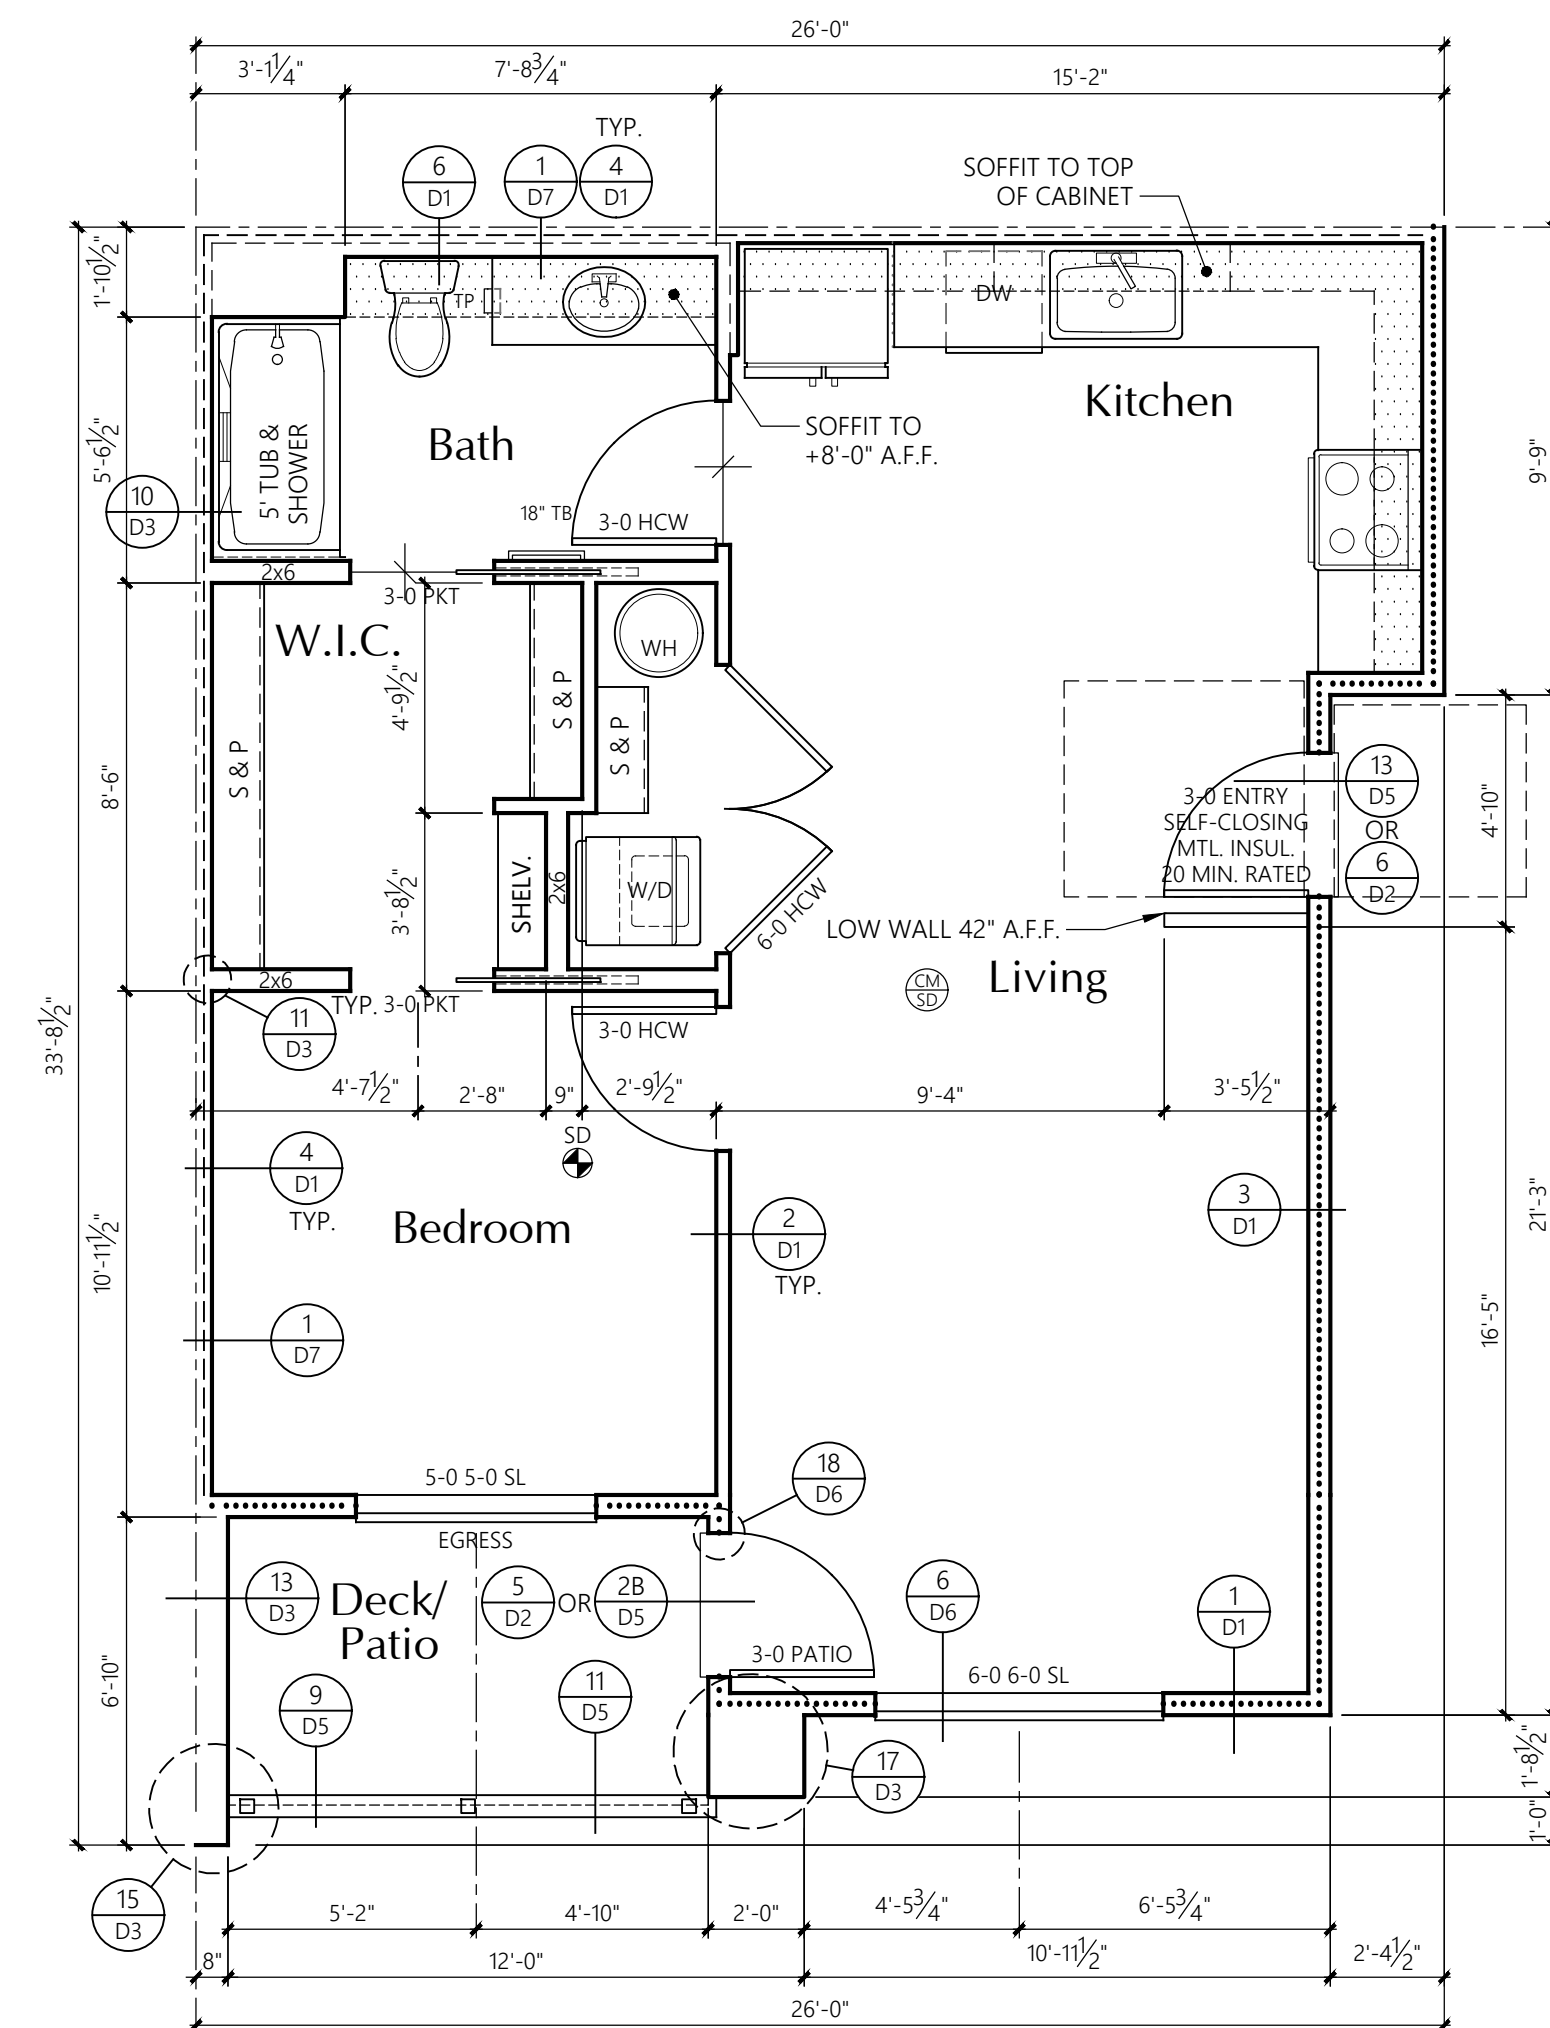

1-BED-INT-1 UNIT TYPE 'B' ACCESSIBLE
BASEMENT & 1st LEVEL FLOOR PLAN

1/4" = 1'-0"

AREA SUMMARY		
Total SF	Heated SF	Patio/Deck SF
61	684	61

UNIT PLAN NOTES

- FRAMING:** 2x6'S AT EXTERIOR WALLS
2x4'S AT INTERIOR WALLS
UNLESS NOTED OTHERWISE.
- R-21 BATT INSULATION U.N.O.
- R-13 BATT INSULATION
3 1/2" ACOUSTICAL INSULATION ONE
SIDE OF PARTYWALL, U.N.O.
- [Pattern] LOCATION OF SOFFIT FOR VENT
RUNS, SOFFIT HEIGHT +8'-0" A.F.F.
U.N.O. ON PLANS; SEE DETAIL 1/D7
- [SD] SMOKE DETECTOR
- [SM] CARBON MONOXIDE/SMOKE DETECTOR
- PROVIDE WATER RESISTANT GYPSUM WALLBOARD
BEHIND TUB AND SHOWER ENCLOSURE MATERIALS TO A
HEIGHT OF 7'-0" MINIMUM ABOVE THE DRAIN INLET.
- NO PLUMBING SHALL BE LOCATED IN THE 1" AIR SPACE OF FIRE
PARTITIONS OR FIRE WALLS.
- ALL BEDROOM AND BATHROOM DOORS SHALL BE UNDERCUT
A MINIMUM OF 1/2" ABOVE THE ADJACENT FLOOR COVERING.
- THE FRONT DOOR SHALL BE OPENABLE FROM THE INSIDE
WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE OR
EFFORT. IT MAY BE PROVIDED WITH A NIGHT LATCH, DEAD
BOLT OR SECURITY CHAIN, PROVIDED SUCH DEVICES ARE
OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR
TOOL, AND MOUNTED NOT TO EXCEED 48" ABOVE THE
FINISHED FLOOR.

DOOR KEY:

- TYPE:** SW = SWING
BF = BIFOLD
BP = BYPASS
- CONSTRUCTION:** HCW = HOLLOW CORE WD.
SCW = SOLID CORE WD.
MTL = METAL
HM = HOLLOW METAL

WINDOW KEY:

- TYPE:** FIX = FIXED/PICTURE
SL = SLIDER
SH = SINGLE HUNG
SGD = SLIDING GLASS DOOR

ACCESSIBILITY NOTES:

ALL GROUND FLOOR UNITS IN THIS PROJECT MUST
MEET THE ACCESSIBILITY REQUIREMENTS OF
TYPE 'B' ACCESSIBLE UNITS AS REQUIRED
BY CHAPTER 11 OF THE 2018 IBC.

INCLUDED IN THE ABOVE GROUND FLOOR UNITS
5% OF ALL UNITS NEED TO MEET THE ACCESSIBILITY
REQUIREMENTS OF TYPE 'A' ACCESSIBLE UNITS
AS REQUIRED BY CHAPTER 11 OF THE 2018 IBC.
SEE BUILDING PLANS FOR LOCATION OF TYPE 'A' UNITS

SEE SHEET U9 FOR SPECIFIC ADAPTABILITY STANDARD
FOR BOTH TYPE 'A' AND TYPE 'B' ACCESSIBLE UNITS.
SEE INTERIOR ELEVATION SHEETS FOR ADDITIONAL
ACCESSIBILITY REQUIREMENTS.

LIGHTING CONTROLS, ELECTRICAL SWITCHES,
ENVIRONMENTAL CONTROLS, OPERATING HARDWARE
FOR DOORS AND WINDOWS, AND PLUMBING
FIXTURE CONTROLS SHALL BE OPERABLE WITH
ONE HAND AND SHALL NOT REQUIRE TIGHT
GRASPING, PINCHING OR TWISTING OF THE WRIST
TO OPERATE. EXCEPT FOR OPERABLE DOOR
HARDWARE, SUCH ITEMS SHALL BE 15" MINIMUM
AND 44" MAXIMUM ABOVE THE FLOOR (48" FOR
WINDOWS).

INSULATION

FOUNDATION PERIMETER - R-10 RIGID INSULATION
TO A DEPTH OF 24" OR TO TOP OF FOOTING AT
HEATED PERIMETER

EXTERIOR WALLS - FIBERGLASS BATTS OR BLANKETS
2x6 WALLS - R21

FLOORS OVER UNHEATED SPACES - R30

ATTICS AND ROOF ASSEMBLIES - R-49

FULL HEIGHT OF UNCOMPRESSED INSULATION
EXTENDS OVER THE WALL TOP PLATE AT
THE EAVES

EXTERIOR DOORS: MAIN ENTRY U=0.20
ALL OTHERS U=0.40

WINDOWS: MILGARD VINYL U-VALUE
TYPE (VINYL) MODEL 0.24 or BETTER

SLIDING 6110 ARGON/LoE 0.24 or BETTER

FIXED 6310 ARGON/LoE 0.24 or BETTER

SINGLE HUNG 6210 ARGON/LoE 0.24 or BETTER

DBL SLIDER 8125 ARGON/LoE 0.24 or BETTER

SGD 6610 ARGON/LoE 0.24 or BETTER

NOTE: ALL CONCEALED OR EXPOSED INSULATION
SHALL HAVE A FLAME SPREAD INDEX OF NOT
MORE THAN 25 AND A SMOKE-DEVELOPED
INDEX OF NOT MORE THAN 450

OPERABLE ENTRY DOOR HARDWARE SHALL BE
34" MINIMUM AND 48" MAXIMUM ABOVE THE FLOOR.

OPENING FORCES FOR ENTRY DOOR SHALL BE:
15 POUNDS TO RELEASE THE LATCH
30 POUNDS TO SET DOOR IN MOTION
15 POUNDS TO OPEN DOOR TO FULL 90°
FORCE MEASURED AT LATCH SIDE OF DOOR.

THE DOOR CLOSER ON THE ENTRY DOOR
SHALL BE ADJUSTED TO CLOSE FROM AN OPEN
POSITION OF 90° TO AN OPEN POSITION OF 12°
IN NOT LESS THAN 5 SECONDS.

OPENING FORCE OF ALL SWINGING INTERIOR
DOORS AND THE SLIDING GLASS DOOR SHALL
NOT EXCEED 5 POUNDS APPLIED TO THE
LATCH SIDE OF THE DOOR.

THE FORCE REQUIRED TO ACTIVATE ALL OTHER
OPERABLE ITEMS LISTED ABOVE SHALL BE
5 POUNDS.

*BIFOLD DOOR HARDWARE AT LAUNDRY TO BE
FULL ACCESS HARDWARE.

THE 30"x48" CLEAR FLOOR
SPACE IS REQUIRED AT EACH
FIXTURE OR LOCATION SHOWN
ON THE FLOOR PLAN.

30x48

CONCEALED SPACES SHALL BE FIRESTOPPED IN BOTH
DIRECTIONS AT 10'-0" ON CENTER AND AT FLOORS. TYPICAL.

ALL ESCAPE OR RESCUE WINDOWS FROM SLEEPING ROOMS
SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE
FEET. THE MINIMUM CLEAR OPENING HEIGHT DIMENSION
SHALL BE 24". MINIMUM CLEAR OPENING WIDTH DIMENSION
SHALL BE 20". EMERGENCY ESCAPE AND RESCUE OPENINGS
SHALL HAVE THE BOTTOM OF CLEAR OPENING NOT GREATER
THAN 44 INCHES MEASURED FROM THE FLOOR.

WHERE THE OPENING OF THE SILL PORTION OF AN OPERABLE
WINDOW IS LOCATED MORE THAN 72 INCHES ABOVE THE
FINISHED GRADE OR OTHER SURFACE BELOW, THE LOWEST
PART OF THE CLEAR OPENING OF THE WINDOW SHALL BE AT
A HEIGHT NOT LESS THAN 36 INCHES ABOVE THE FINISHED
FLOOR SURFACE OF THE ROOM IN WHICH THE WINDOW IS
LOCATED. OPERABLE SECTIONS OF WINDOWS SHALL NOT
PERMIT OPENINGS THAT ALLOW PASSAGE OF A 4 INCH
DIAMETER SPHERE WHERE SUCH OPENINGS ARE LOCATED
WITHIN 36 INCHES OF THE FINISHED FLOOR.

ALL GLAZING SHALL CONFORM TO THE 2018 IBC,
CHAPTER 24, SEC. 2406, SAFETY GLAZING. GLAZING IN ALL
DOORS SHALL BE SAFETY TYPE AND ALL GLAZING WITHIN A
24" ARC OF EITHER VERTICAL EDGE SHALL BE SAFETY TYPE.

PROVIDE 3/8" TYPE 'X' (MIN.) GYPSUM SHEATHING ON WALLS
BEHIND TUB/SHOWERS TO SATISFY FIRE REQUIREMENTS AT
PARTYWALL CONDITION. PROVIDE 3/8" PLYWOOD UNDER TUB
IN PLACE OF THE GYPCRETE, SEE DETAIL 14/D1

UNIT PLAN NOTES

- FRAMING:**
- 2x6'S AT EXTERIOR WALLS
 - 2x4'S AT INTERIOR WALLS UNLESS NOTED OTHERWISE.
 - R-21 BATT INSULATION U.N.O.
 - R-13 BATT INSULATION
 - 3/8" ACOUSTICAL INSULATION ONE SIDE OF PARTYWALL, U.N.O.
 - LOCATION OF SOFFIT FOR VENT RUNS. SOFFIT HEIGHT +8'-0" A.F.F. U.N.O. ON PLANS; SEE DETAIL 1/07
 - SMOKE DETECTOR
 - CARBON MONOXIDE/SMOKE DETECTOR

PROVIDE WATER RESISTANT GYPSUM WALLBOARD BEHIND TUB AND SHOWER ENCLOSURE MATERIALS TO A HEIGHT OF 70" MINIMUM ABOVE THE DRAIN INLET.

NO PLUMBING SHALL BE LOCATED IN THE 1" AIR SPACE OF FIRE PARTITIONS OR FIRE WALLS.

ALL BEDROOM AND BATHROOM DOORS SHALL BE UNDERCUT A MINIMUM OF 1/2" ABOVE THE ADJACENT FLOOR COVERING.

THE FRONT DOOR SHALL BE OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE OR EFFORT. IT MAY BE PROVIDED WITH A NIGHT LATCH, DEAD BOLT OR SECURITY CHAIN, PROVIDED SUCH DEVICES ARE OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR TOOL, AND MOUNTED NOT TO EXCEED 48" ABOVE THE FINISHED FLOOR.

GYPSUM WALLBOARD SCHEDULE

EXCEPT WHERE NOTED OTHERWISE, 5/8" TYPE 'X' GYPSUM WALLBOARD SHALL BE USED THROUGHOUT; ON INTERIOR NON-RATED WALLS, EXTERIOR WALLS, CORRIDOR WALLS, AND 1-HOUR AND 2-HOUR FIRE-RATED WALLS.

DOOR KEY:

TYPE: SW = SWING, BF = BIFOLD, BP = BYPASS

CONSTRUCTION: HCW = HOLLOW CORE WD., SCW = SOLID CORE WD., MTL = METAL, HM = HOLLOW METAL

WINDOW KEY:

TYPE: FIX = FIXED/PICTURE, SL = SLIDER, SH = SINGLE HUNG, SGD = SLIDING GLASS DOOR

ACCESSIBILITY NOTES:

ALL GROUND FLOOR UNITS IN THIS PROJECT MUST MEET THE ACCESSIBILITY REQUIREMENTS OF 'TYPE B' ACCESSIBLE UNITS AS REQUIRED BY CHAPTER 11 OF THE 2018 IBC.

CONCEALED SPACES SHALL BE FIRESTOPPED IN BOTH DIRECTIONS AT 10'-0" ON CENTER AND AT FLOORS. TYPICAL.

ALL ESCAPE OR RESCUE WINDOWS FROM SLEEPING ROOMS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE FEET. THE MINIMUM CLEAR OPENING HEIGHT DIMENSION SHALL BE 24". MINIMUM CLEAR OPENING WIDTH DIMENSION SHALL BE 20". EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE THE BOTTOM OF CLEAR OPENING NOT GREATER THAN 44 INCHES MEASURED FROM THE FLOOR.

WHERE THE OPENING OF THE SILL PORTION OF AN OPERABLE WINDOW IS LOCATED MORE THAN 72 INCHES ABOVE THE FINISHED GRADE OR OTHER SURFACE BELOW, THE LOWEST PART OF THE CLEAR OPENING OF THE WINDOW SHALL BE AT A HEIGHT NOT LESS THAN 36 INCHES ABOVE THE FINISHED FLOOR SURFACE OF THE ROOM IN WHICH THE WINDOW IS LOCATED. OPERABLE SECTIONS OF WINDOWS SHALL NOT PERMIT OPENINGS THAT ALLOW PASSAGE OF A 4 INCH DIAMETER SPHERE WHERE SUCH OPENINGS ARE LOCATED WITHIN 36 INCHES OF THE FINISHED FLOOR.

ALL GLAZING SHALL CONFORM TO THE 2018 IBC, CHAPTER 24, SEC. 2406, SAFETY GLAZING. GLAZING IN ALL DOORS SHALL BE SAFETY TYPE AND ALL GLAZING WITHIN A 24" ARC OF EITHER VERTICAL EDGE SHALL BE SAFETY TYPE.

PROVIDE 3/4" TYPE 'X' (MIN.) GYPSUM SHEATHING ON WALLS BEHIND TUB/SHOWERS TO SATISFY FIRE REQUIREMENTS AT PARTYWALL CONDITION. PROVIDE 3/4" PLYWOOD UNDER TUB IN PLACE OF THE GYPCRETE. SEE DETAIL 14/D1

INSULATION

FOUNDATION PERIMETER - R-10 RIGID INSULATION TO A DEPTH OF 24" OR TO TOP OF FOOTING AT HEATED PERIMETER

EXTERIOR WALLS: FIBERGLASS BATTS OR BLANKETS 2x6 WALLS - R21

FLOORS OVER UNHEATED SPACES - R30

ATTICS AND ROOF ASSEMBLIES - R-49

FULL HEIGHT OF UNCOMPRESSED INSULATION EXTENDS OVER THE WALL TOP PLATE AT THE EAVES

EXTERIOR DOORS: MAIN ENTRY U=0.20
ALL OTHERS U=0.40

WINDOWS: MILGARD VINYL

TYPE (VINYL)	MODEL	U-VALUE
SLIDING	6110 ARGON/LoE	0.24 or BETTER
FIXED	6310 ARGON/LoE	0.24 or BETTER
SINGLE HUNG	6210 ARGON/LoE	0.24 or BETTER
DBL. SLIDER	8125 ARGON/LoE	0.24 or BETTER
SGD	6610 ARGON/LoE	0.24 or BETTER


NOTE: ALL CONCEALED OR EXPOSED INSULATION SHALL HAVE A FLAME SPREAD INDEX OF NOT MORE THAN 25 AND A SMOKE-DEVELOPED INDEX OF NOT MORE THAN 450

STANDARD PLATE HEIGHT: 9'-1"

SEE ELEVATION SHEETS FOR FLOOR TO FLOOR HEIGHTS


WINDOW HDR IS 8'-0" UNLESS NOTED OTHERWISE

SEE SHEET U6 FOR INTERIOR ELEVATIONS AND ACCESSIBILITY REQUIREMENTS.

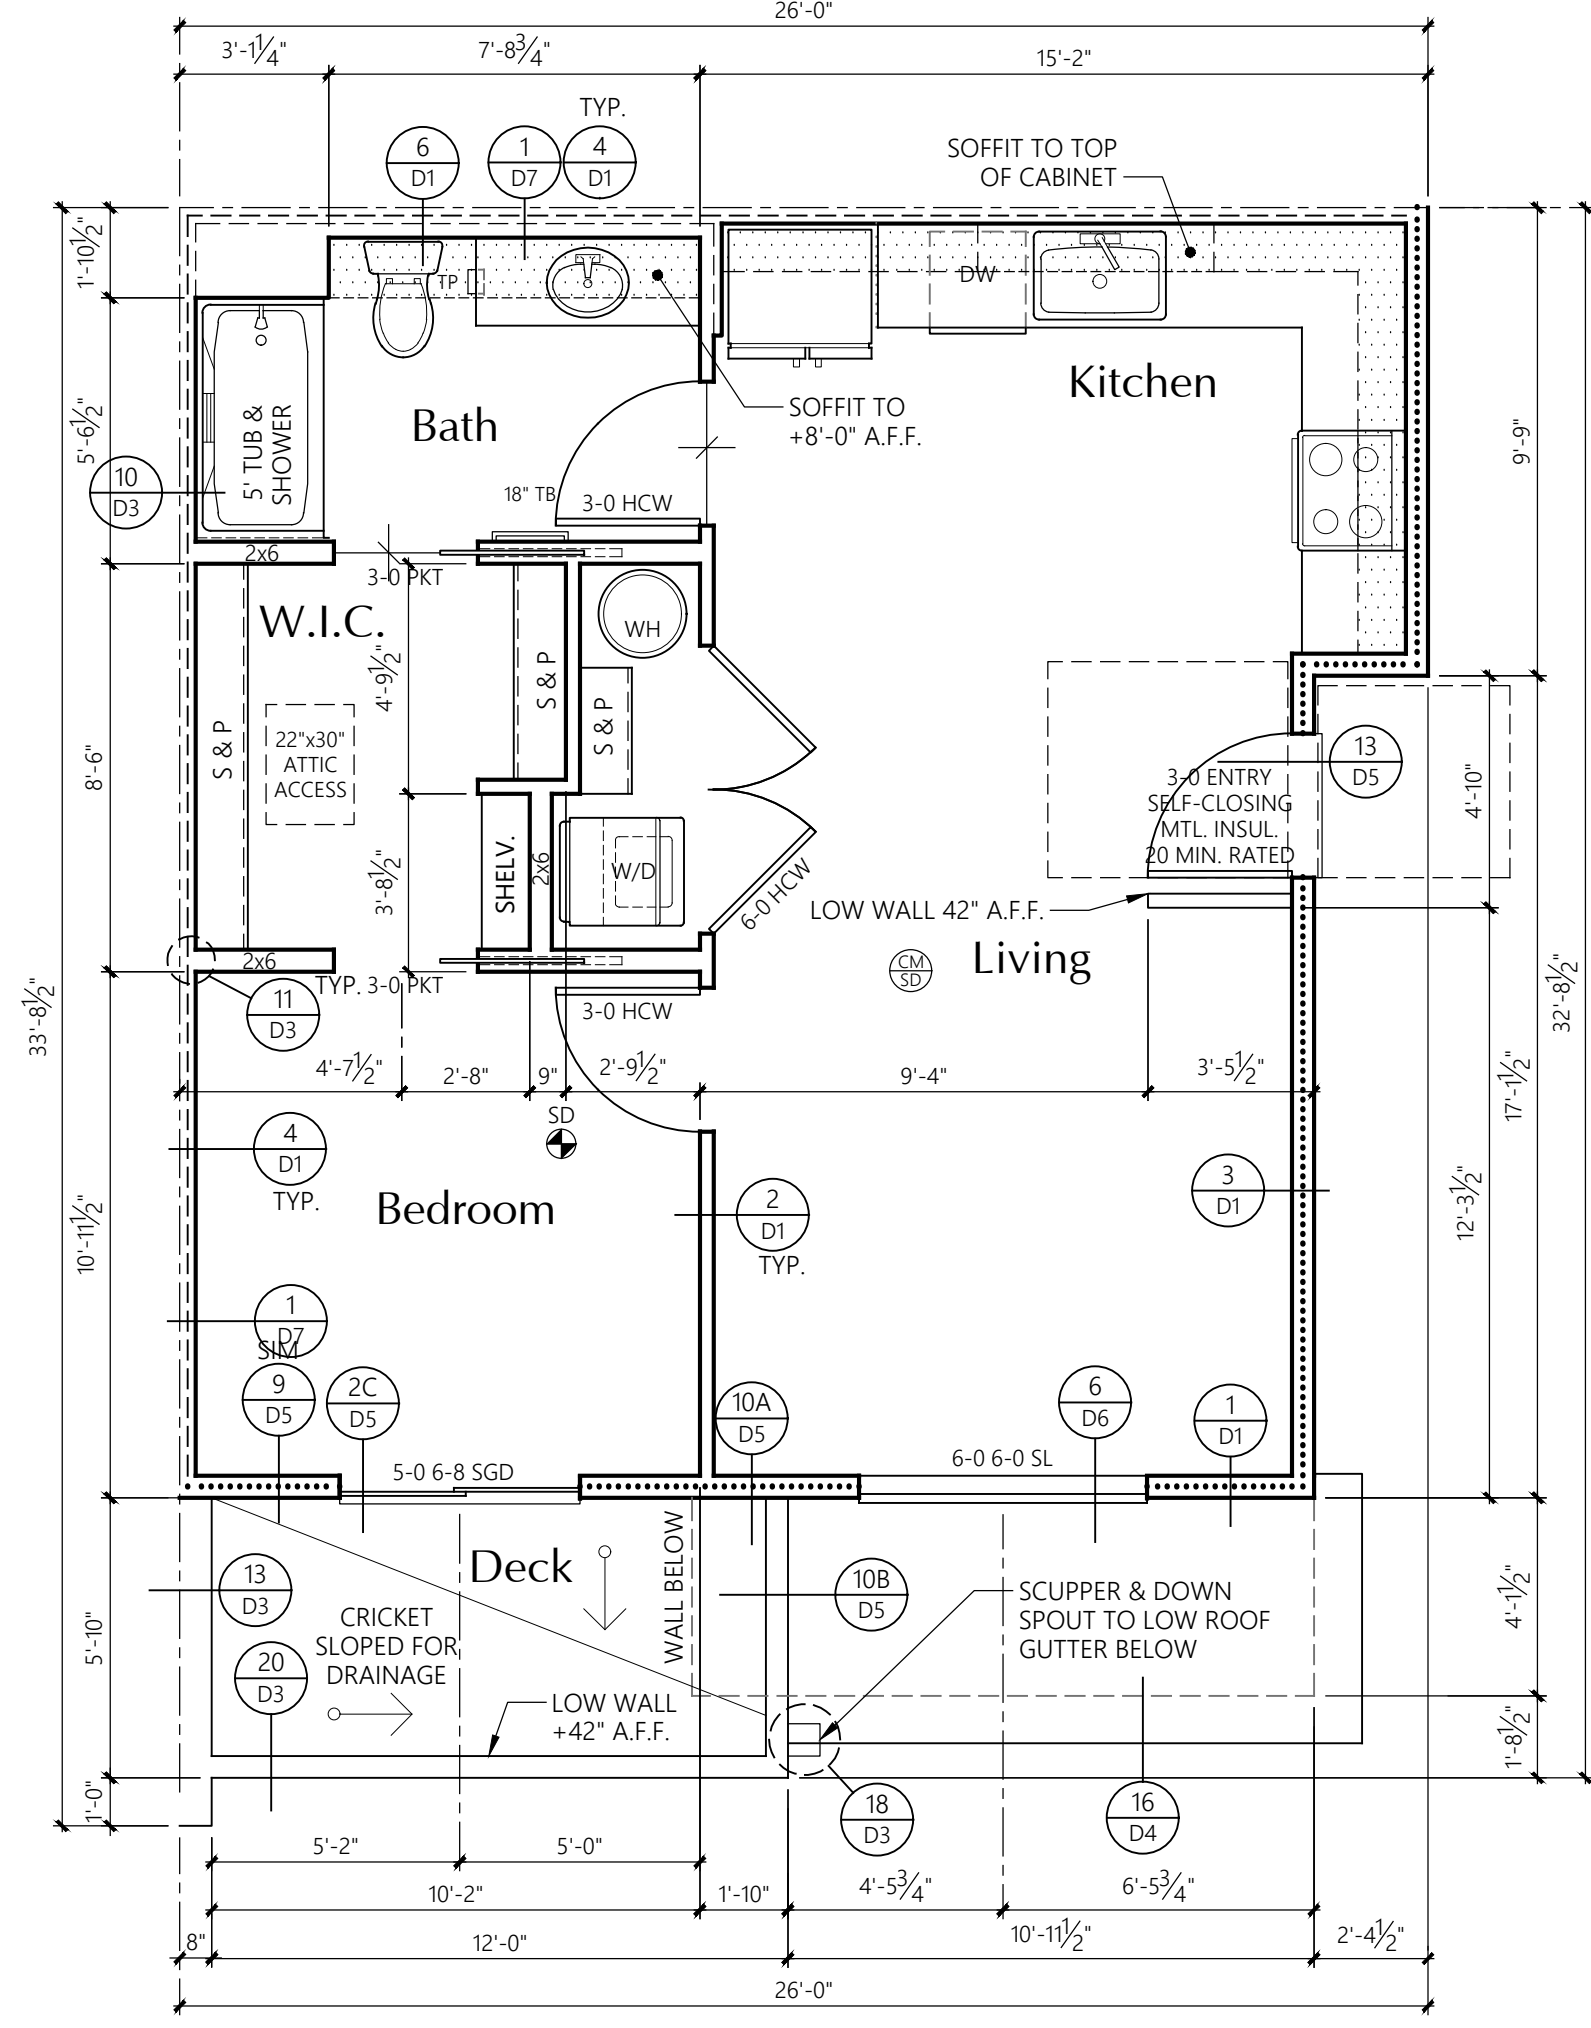


1-BED-INT-ALT-1 ALTERNATE 3rd LEVEL FLOOR PLAN
1/4" = 1'-0"

AREA SUMMARY		
	Heated SF	Deck/Patio SF
Total SF	634	74

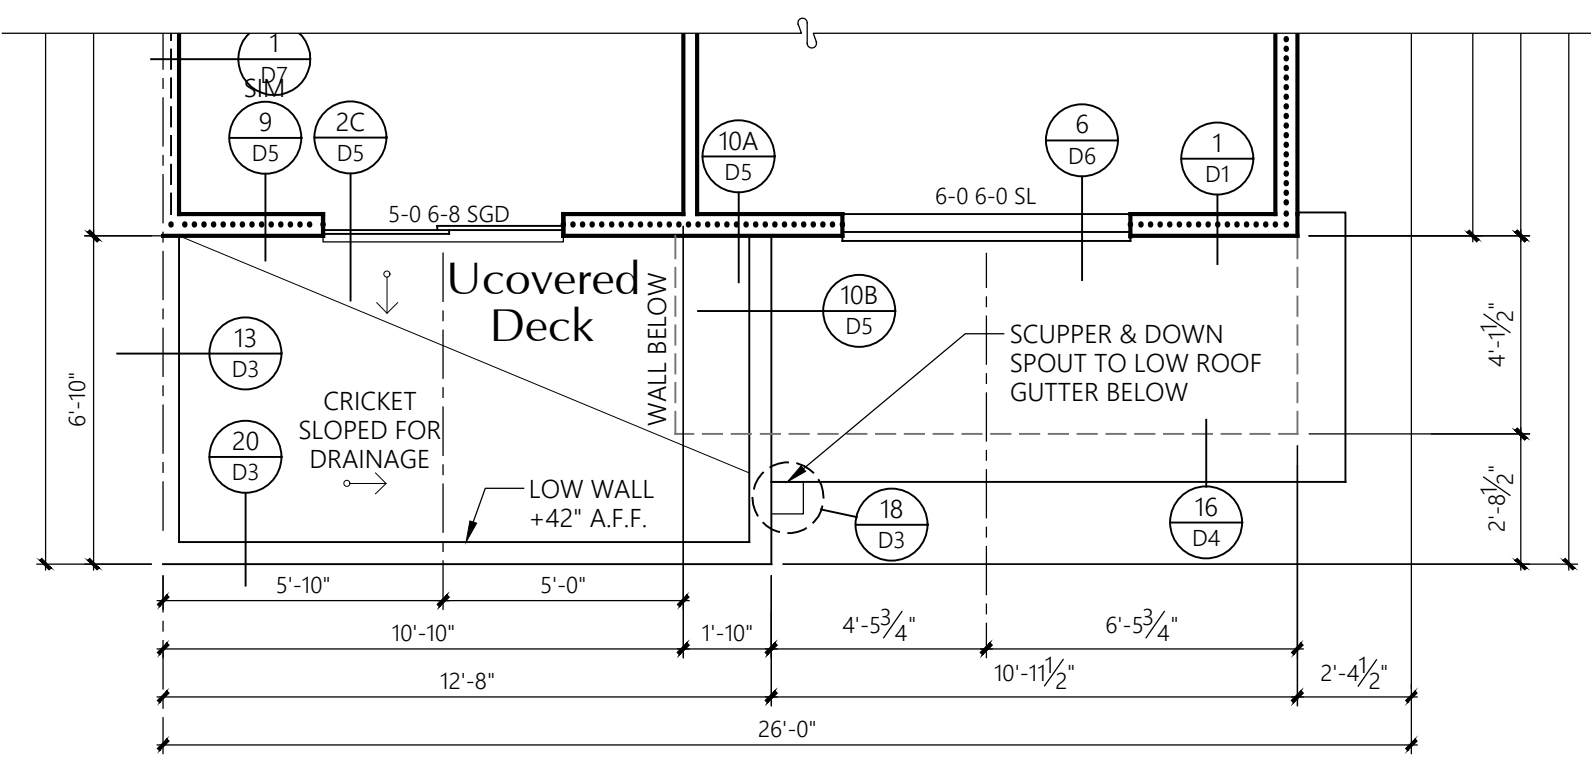

1-BED-INT-ALT-2 ALTERNATE 3rd LEVEL FLOOR PLAN
1/4" = 1'-0"


AREA SUMMARY		
	Heated SF	Deck/Patio SF
Total SF	634	86

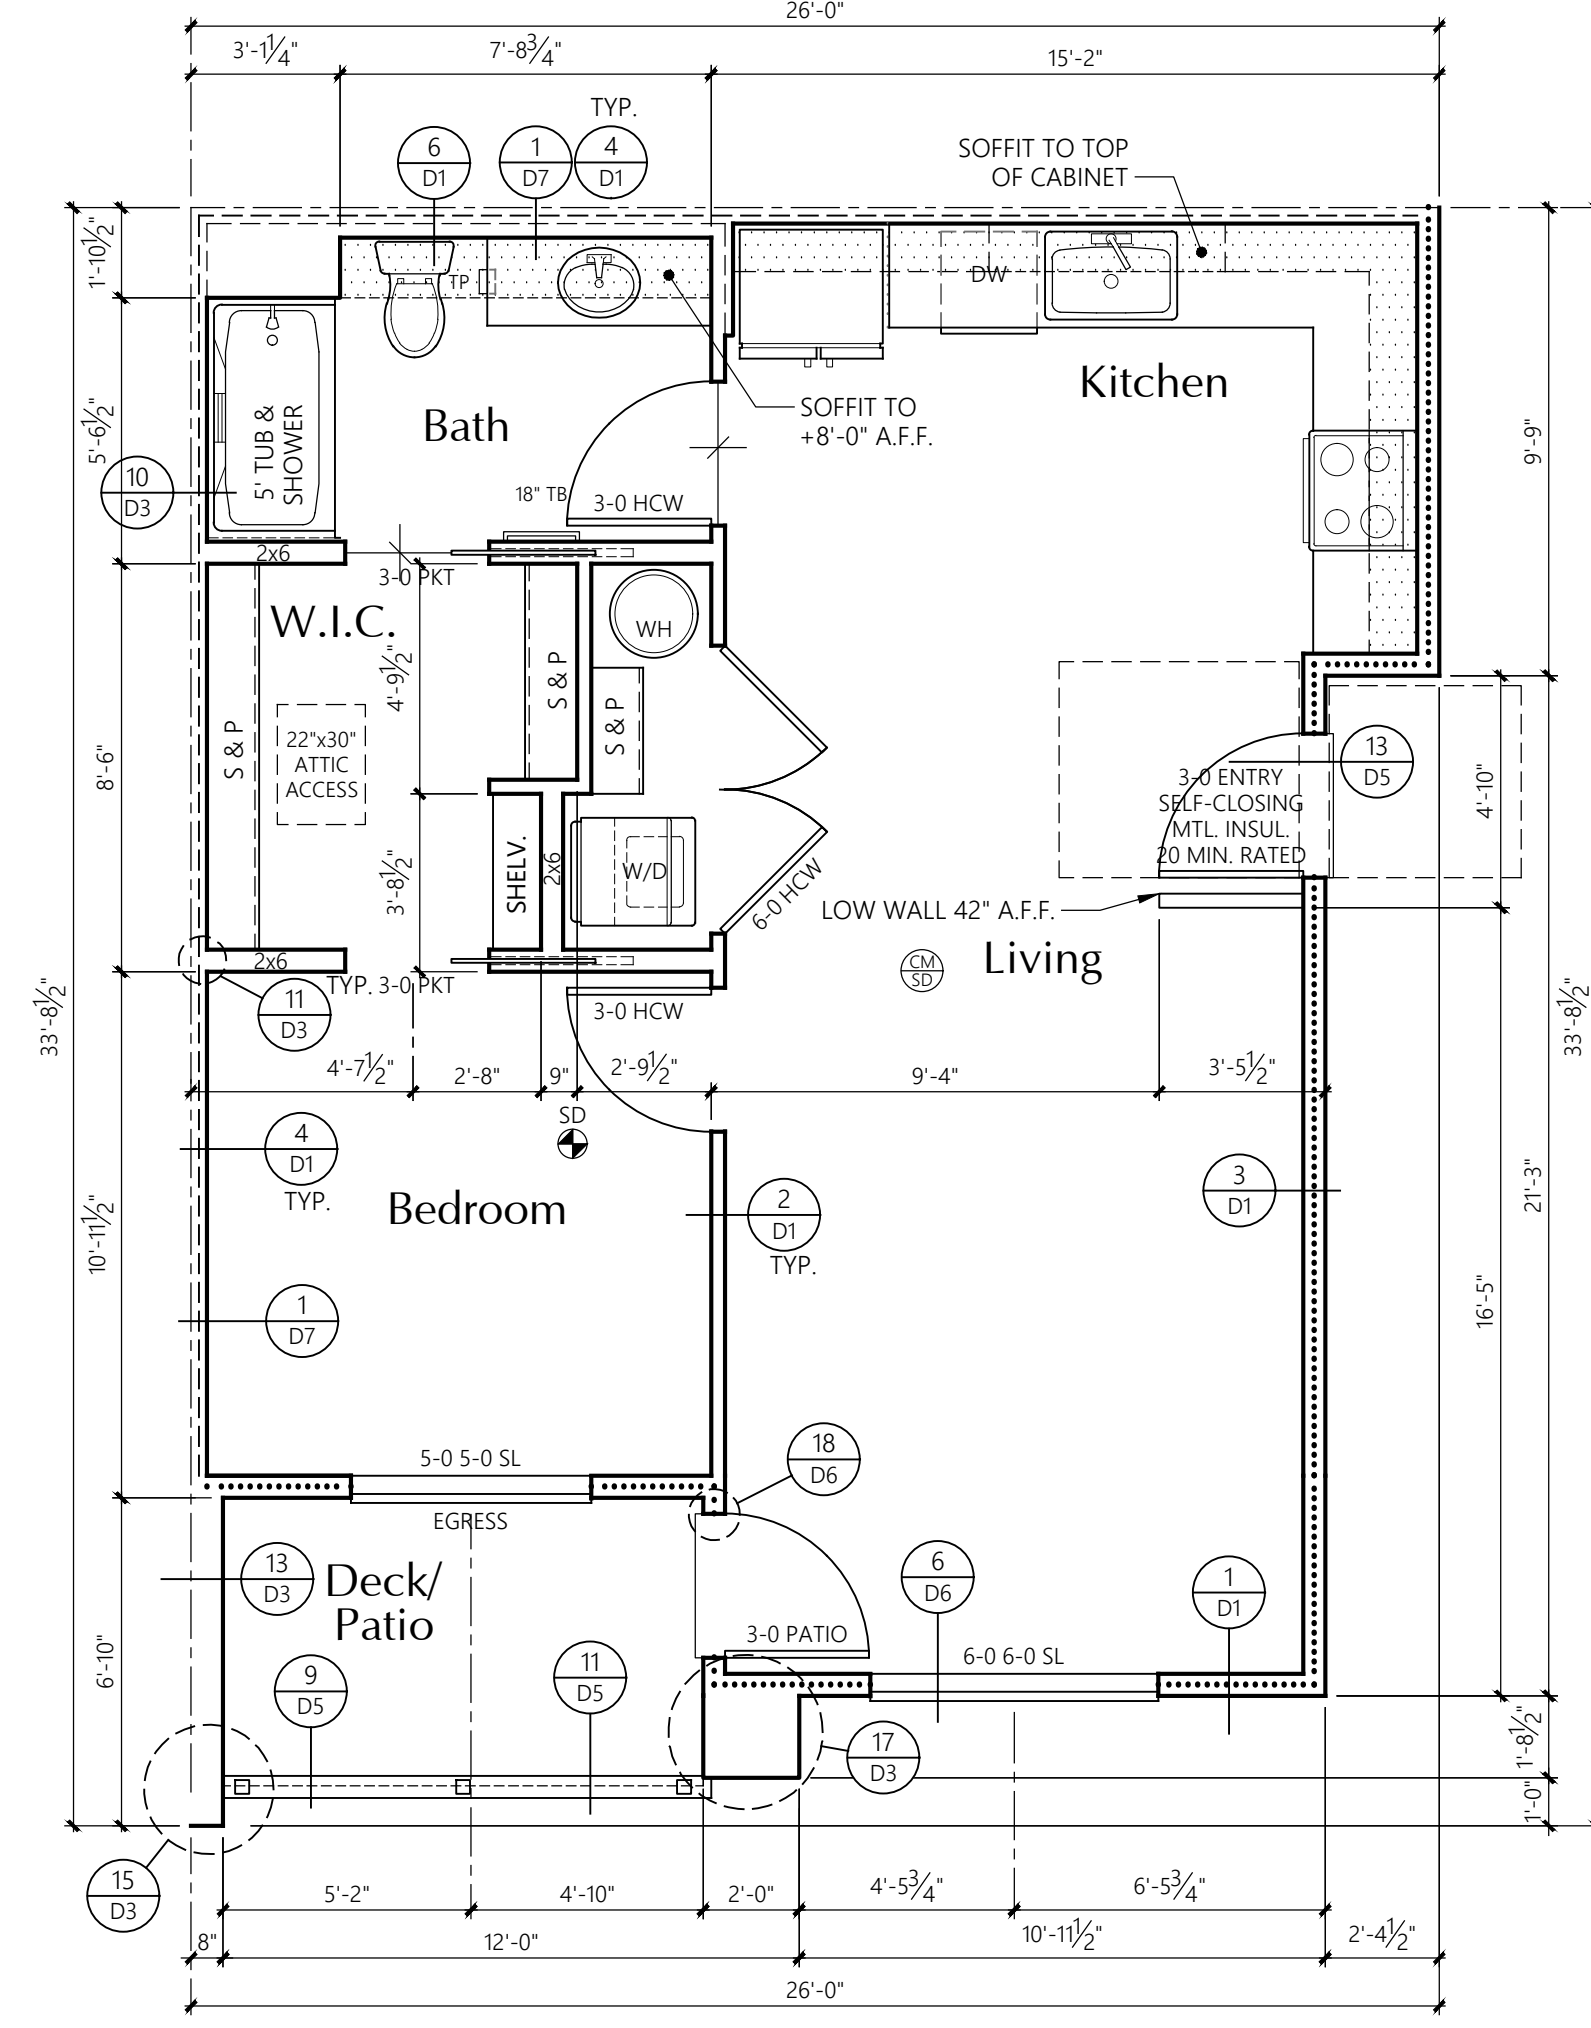

1-BED-INT-1 UNIT NON-ACCESSIBLE 2nd & 3rd LEVEL FLOOR PLAN
1/4" = 1'-0"

AREA SUMMARY		
	Heated SF	Patio/Deck SF
Total SF	684	61

* Side of exterior walls to which area was measured

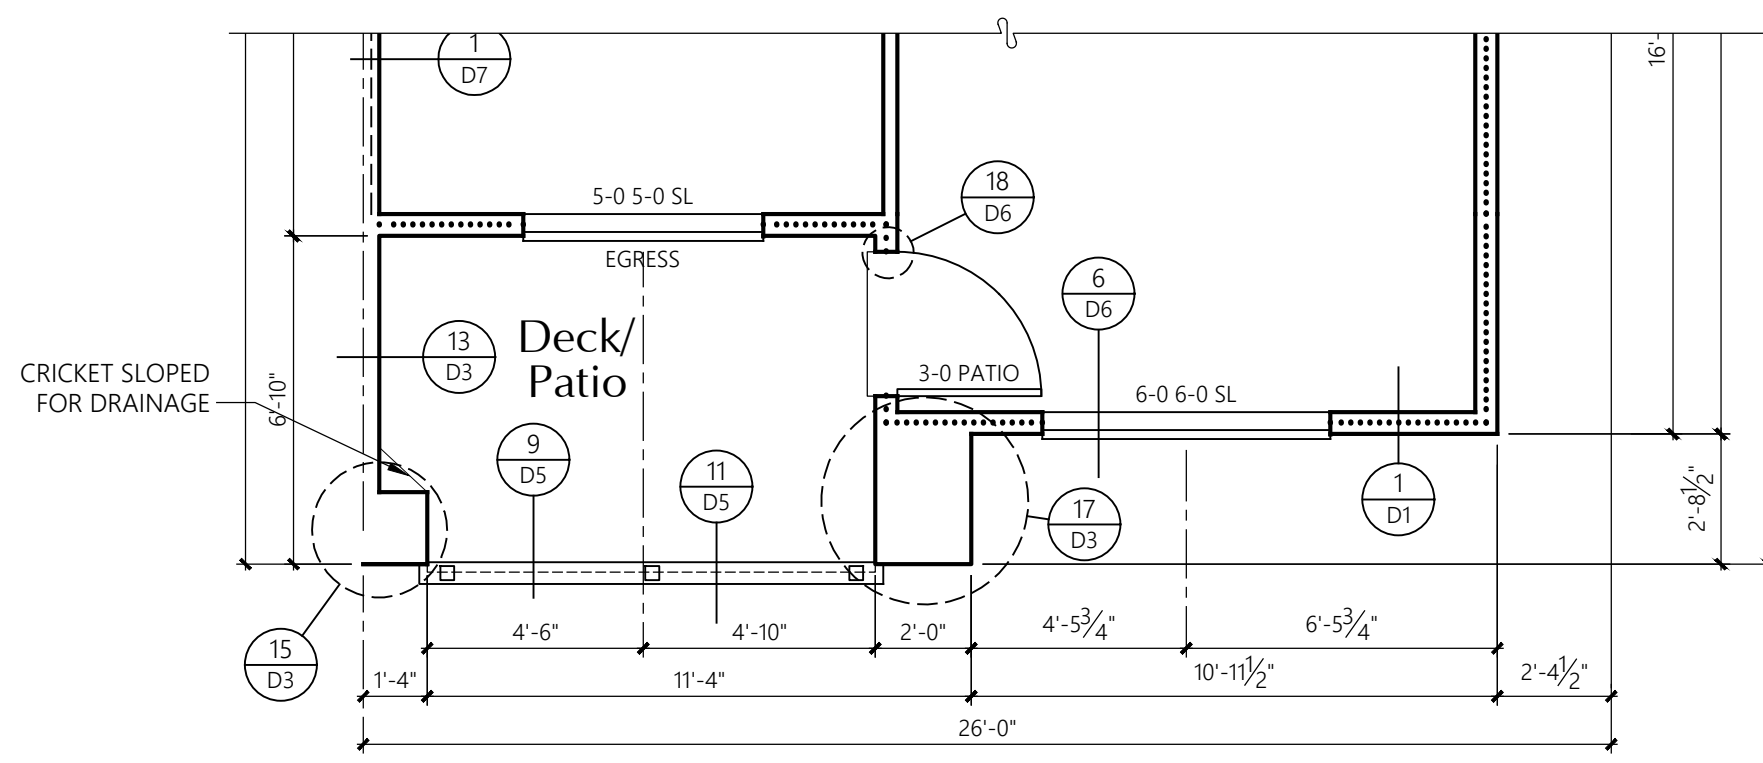


1-BED-INT-2 UNIT NON-ACCESSIBLE 2nd & 3rd LEVEL FLOOR PLAN
1/4" = 1'-0"

AREA SUMMARY		
	Heated SF	Patio/Deck SF
Total SF	684	71

* Side of exterior walls to which area was measured



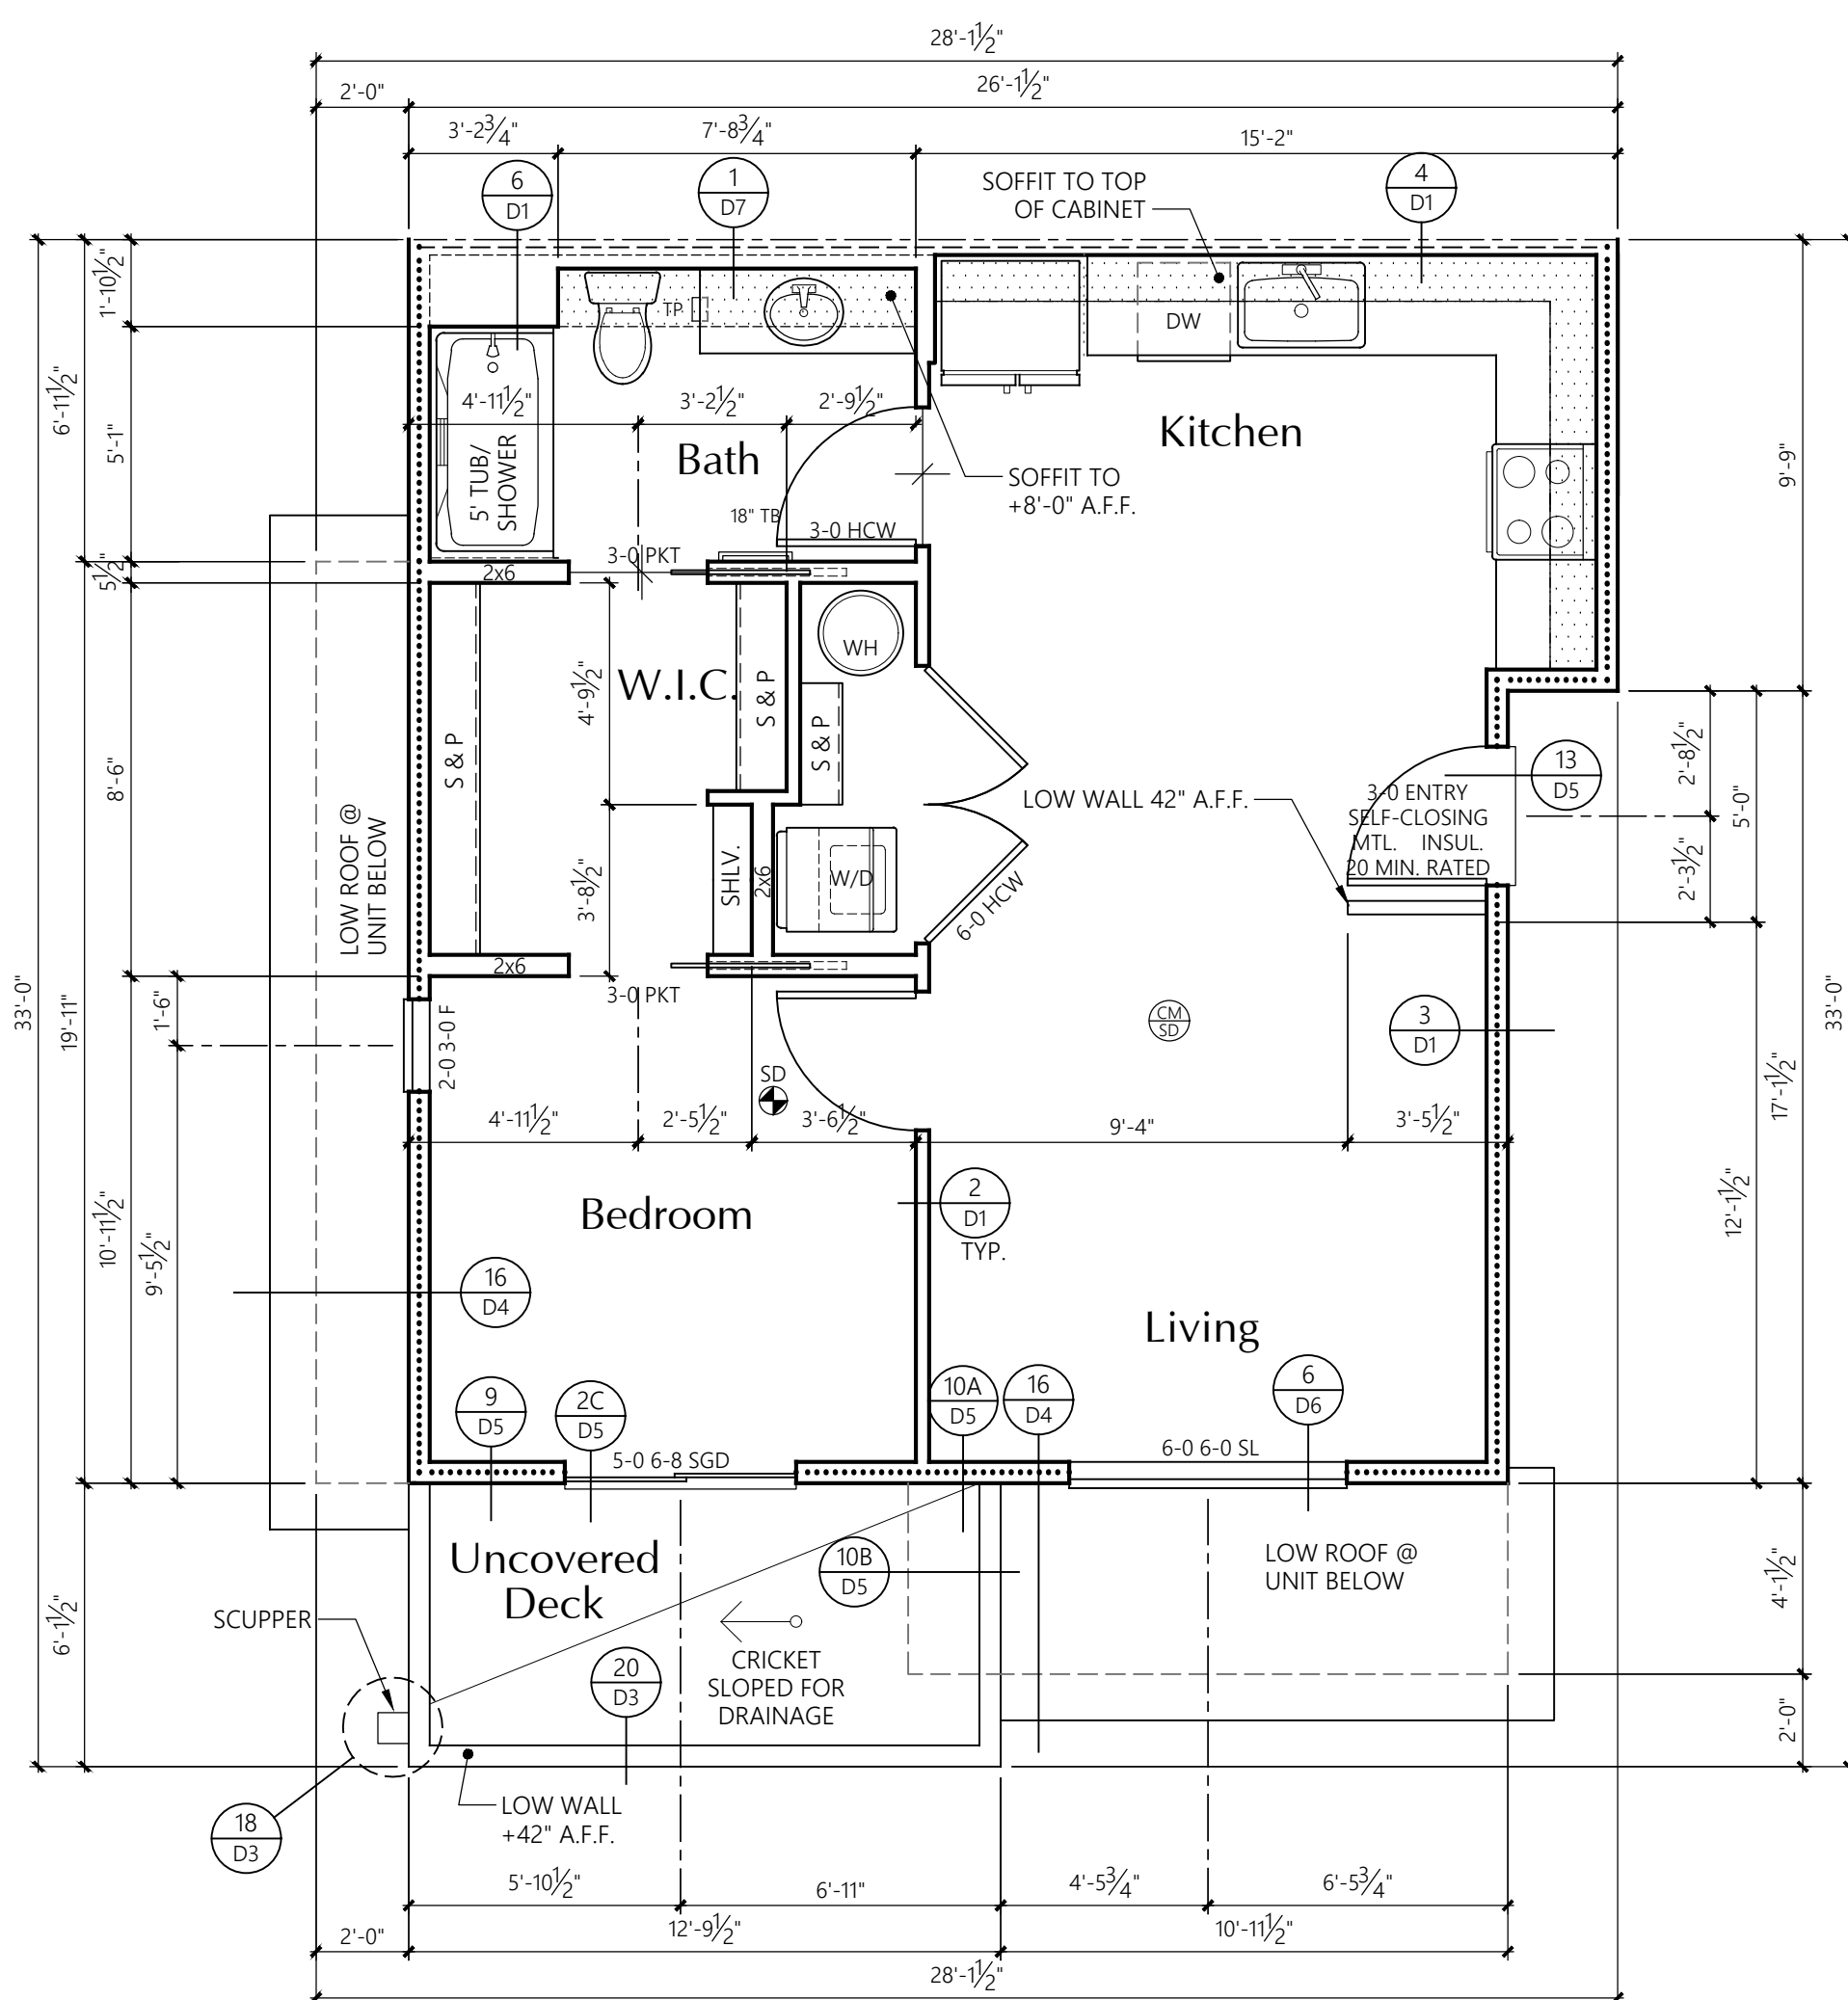


1-BED-END-ALT UNIT

1/4" = 1'-0"

ALTERNATE
3rd LEVEL FLOOR PLAN

AREA SUMMARY		
	Heated SF	Deck/Patio SF
Total SF	625	78

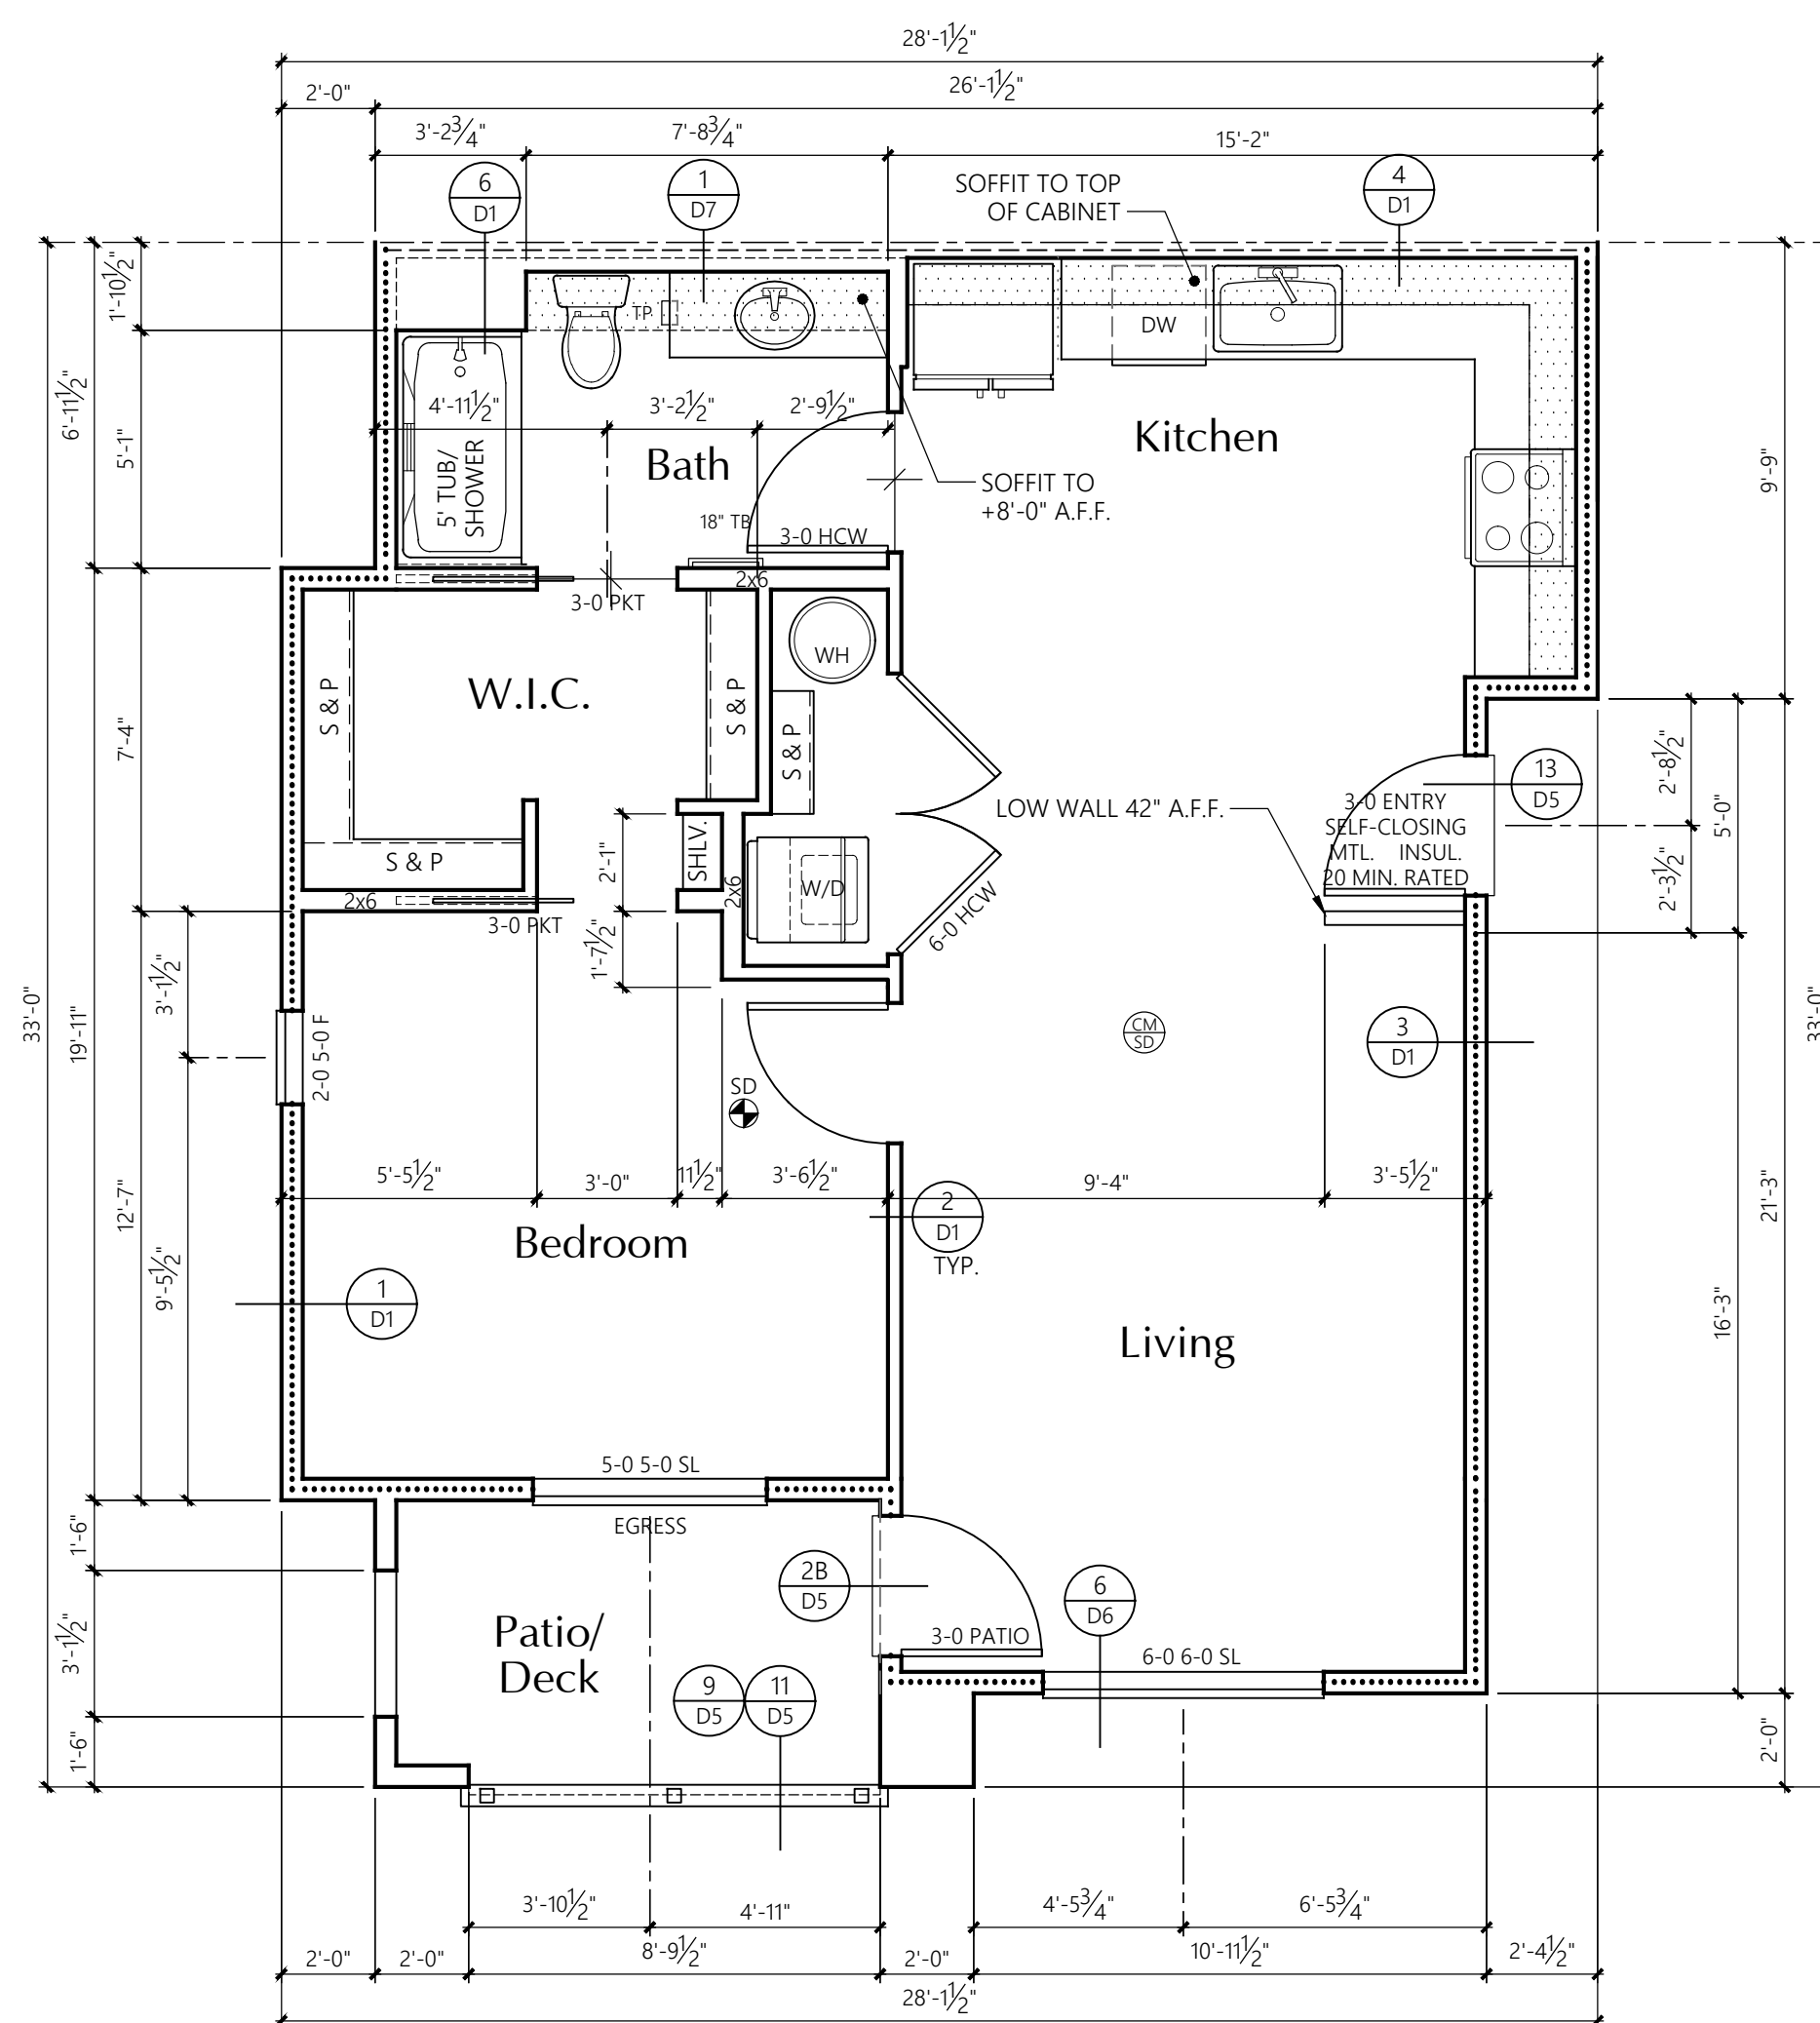


1-BED-END UNIT

1/4" = 1'-0"

NON-ACCESSIBLE
2nd & 3rd LEVEL FLOOR PLAN

AREA SUMMARY		
	Heated SF	Deck/Patio SF
Total SF	712	67

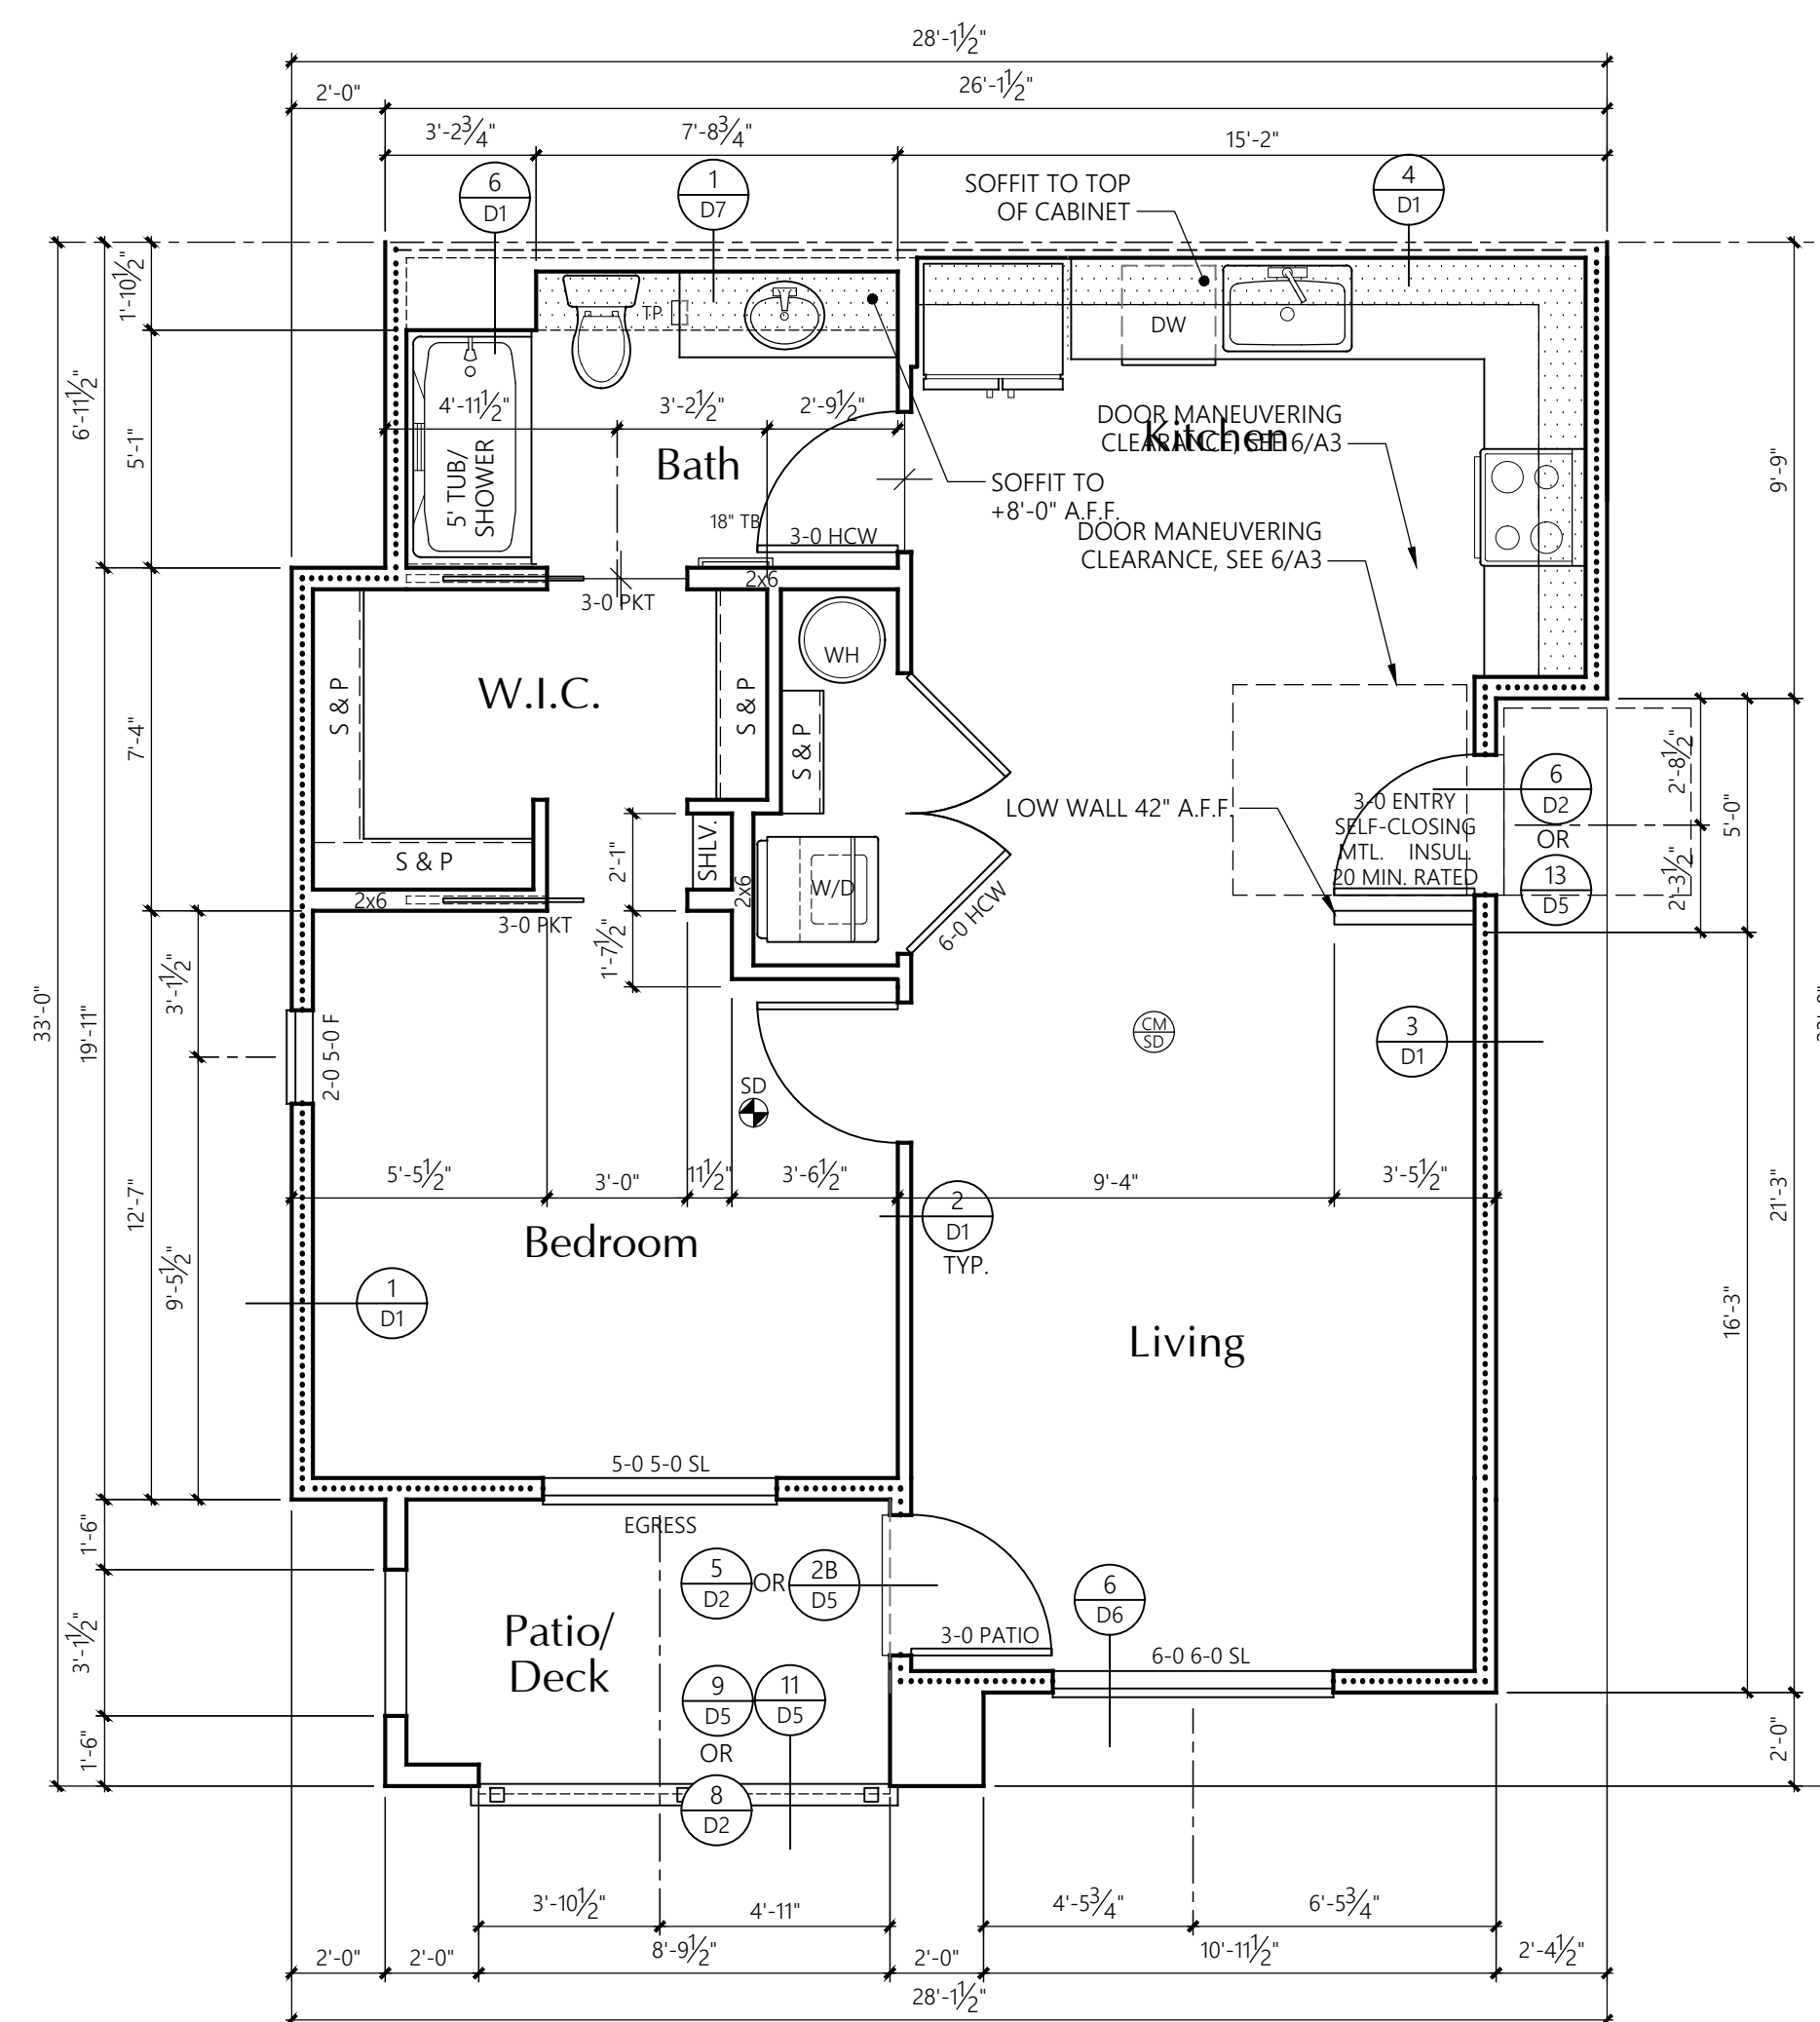

1-BED-END UNIT

1/4" = 1'-0"

TYPE 'B' ACCESSIBLE
1st LEVEL FLOOR PLAN

AREA SUMMARY		
	Heated SF	Deck/Patio SF
Total SF	712	67

UNIT PLAN NOTES

- FRAMING:
- 2x6'S AT EXTERIOR WALLS
2x4'S AT INTERIOR WALLS
UNLESS NOTED OTHERWISE.
 - R-21 BATT INSULATION U.N.O.
 - R-13 BATT INSULATION
 - 3/4" ACOUSTICAL INSULATION ONE SIDE OF PARTYWALL, U.N.O.
 - LOCATION OF SOFFIT FOR VENT RUNS. SOFFIT HEIGHT +8'-0" A.F.F. U.N.O. ON PLANS; SEE DETAIL V/D7
 - SMOKE DETECTOR
 - CARBON MONOXIDE/SMOKE DETECTOR

PROVIDE WATER RESISTANT GYPSUM WALLBOARD BEHIND TUB AND SHOWER ENCLOSURE MATERIALS TO A HEIGHT OF 70" MINIMUM ABOVE THE DRAIN INLET.

NO PLUMBING SHALL BE LOCATED IN THE 1" AIR SPACE OF FIRE PARTITIONS OR FIRE WALLS.

ALL BEDROOM AND BATHROOM DOORS SHALL BE UNDERCUT A MINIMUM OF 1/2" ABOVE THE ADJACENT FLOOR COVERING.

THE FRONT DOOR SHALL BE OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE OR EFFORT. IT MAY BE PROVIDED WITH A NIGHT LATCH, DEAD BOLT OR SECURITY CHAIN, PROVIDED SUCH DEVICES ARE OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR TOOL, AND MOUNTED NOT TO EXCEED 48" ABOVE THE FINISHED FLOOR.

GYPSUM WALLBOARD SCHEDULE EXCEPT WHERE NOTED OTHERWISE, 3/8" TYPE 'X' GYPSUM WALLBOARD SHALL BE USED THROUGHOUT; ON INTERIOR NON-RATED WALLS, EXTERIOR WALLS, CORRIDOR WALLS, AND 1-HOUR AND 2-HOUR FIRE-RATED WALLS.

STANDARD PLATE HEIGHT: 9'-1"

SEE ELEVATION SHEETS FOR FLOOR TO FLOOR HEIGHTS

WINDOW HDR IS 8'-0" UNLESS NOTED OTHERWISE

SEE SHEET U7 FOR INTERIOR ELEVATIONS AND ACCESSIBILITY REQUIREMENTS.

CONCEALED SPACES SHALL BE FIRESTOPPED IN BOTH DIRECTIONS AT 10'-0" ON CENTER AND AT FLOORS. TYPICAL.

ALL ESCAPE OR RESCUE WINDOWS FROM SLEEPING ROOMS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE FEET. THE MINIMUM CLEAR OPENING HEIGHT DIMENSION SHALL BE 24". EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE THE BOTTOM OF CLEAR OPENING NOT GREATER THAN 44 INCHES MEASURED FROM THE FLOOR.

WHERE THE OPENING OF THE SILL PORTION OF AN OPERABLE WINDOW IS LOCATED MORE THAN 72 INCHES ABOVE THE FINISHED GRADE OR OTHER SURFACE BELOW, THE LOWEST PART OF THE CLEAR OPENING OF THE WINDOW SHALL BE AT A HEIGHT NOT LESS THAN 36 INCHES ABOVE THE FINISHED FLOOR SURFACE OF THE ROOM IN WHICH THE WINDOW IS LOCATED. OPERABLE SECTIONS OF WINDOWS SHALL NOT PERMIT OPENINGS THAT ALLOW PASSAGE OF A 4 INCH DIAMETER SPHERE WHERE SUCH OPENINGS ARE LOCATED WITHIN 36 INCHES OF THE FINISHED FLOOR.

ALL GLAZING SHALL CONFORM TO THE 2018 IBC, CHAPTER 24, SEC. 2406, SAFETY GLAZING. GLAZING IN ALL DOORS SHALL BE SAFETY TYPE AND ALL GLAZING WITHIN A 24" ARC OF EITHER VERTICAL EDGE SHALL BE SAFETY TYPE.

PROVIDE 3/4" TYPE 'X' (MIN) GYPSUM SHEATHING ON WALLS BEHIND TUB/SHOWERS TO SATISFY FIRE REQUIREMENTS AT PARTYWALL CONDITION. PROVIDE 3/8" PLYWOOD UNDER TUB IN PLACE OF THE GYPCRETE, SEE DETAIL 14/D1

DOOR KEY:

- TYPE:
- SW = SWING
 - BF = BIFOLD
 - BP = BYPASS
- CONSTRUCTION:
- HCW = HOLLOW CORE WD.
 - SCW = SOLID CORE WD.
 - MTL = METAL
 - HM = HOLLOW METAL

WINDOW KEY:

- TYPE:
- FIX = FIXED/PICTURE
 - SL = SLIDER
 - SH = SINGLE HUNG
 - SGD = SLIDING GLASS DOOR

INSULATION

FOUNDATION PERIMETER - R-10 RIGID INSULATION TO A DEPTH OF 24" OR TO TOP OF FOOTING AT HEATED PERIMETER

EXTERIOR WALLS: FIBERGLASS BATTS OR BLANKETS 2x6 WALLS - R21

FLOORS OVER UNHEATED SPACES - R30

ATTICS AND ROOF ASSEMBLIES - R-49

FULL HEIGHT OF UNCOMPRESSED INSULATION EXTENDS OVER THE WALL TOP PLATE AT THE EAVES

EXTERIOR DOORS: MAIN ENTRY U=0.20
ALL OTHERS U=0.40

WINDOWS: MILGARD VINYL MODEL U-VALUE

SLIDING	6110 ARGON/LoE	0.24 or BETTER
FIXED	6310 ARGON/LoE	0.24 or BETTER
SINGLE HUNG	6210 ARGON/LoE	0.24 or BETTER
DBL. SLIDER	8125 ARGON/LoE	0.24 or BETTER
SGD	6610 ARGON/LoE	0.24 or BETTER

NOTE: ALL CONCEALED OR EXPOSED INSULATION SHALL HAVE A FLAME SPREAD INDEX OF NOT MORE THAN 25 AND A SMOKE-DEVELOPED INDEX OF NOT MORE THAN 450

ACCESSIBILITY NOTES:

ALL GROUND FLOOR UNITS IN THIS PROJECT MUST MEET THE ACCESSIBILITY REQUIREMENTS OF 'TYPE B' ACCESSIBLE UNITS AS REQUIRED BY CHAPTER 11 OF THE 2018 IBC.

INCLUDED IN THE ABOVE GROUND FLOOR UNITS 5% OF ALL UNITS NEED TO MEET THE ACCESSIBILITY REQUIREMENTS OF 'TYPE A' ACCESSIBLE UNITS AS REQUIRED BY CHAPTER 11 OF THE 2018 IBC. SEE BUILDING PLANS FOR LOCATION OF 'TYPE A' UNITS

SEE SHEET U9 FOR SPECIFIC ADAPTABILITY STANDARD FOR BOTH 'TYPE A' AND 'TYPE B' ACCESSIBLE UNITS. SEE INTERIOR ELEVATION SHEETS FOR ADDITIONAL ACCESSIBILITY REQUIREMENTS.

LIGHTING CONTROLS, ELECTRICAL SWITCHES, ENVIRONMENTAL CONTROLS, OPERATING HARDWARE FOR DOORS AND WINDOWS, AND PLUMBING FIXTURE CONTROLS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING OR TWISTING OF THE WRIST TO OPERATE. EXCEPT FOR OPERABLE DOOR HARDWARE, SUCH ITEMS SHALL BE 15" MINIMUM AND 44" MAXIMUM ABOVE THE FLOOR (48" FOR WINDOWS).

OPERABLE ENTRY DOOR HARDWARE SHALL BE 34" MINIMUM AND 48" MAXIMUM ABOVE THE FLOOR.

OPENING FORCES FOR ENTRY DOOR SHALL BE: 15 POUNDS TO RELEASE THE LATCH
30 POUNDS TO SET DOOR IN MOTION
15 POUNDS TO OPEN DOOR TO FULL 90° FORCE MEASURED AT LATCH SIDE OF DOOR.


THE DOOR CLOSER ON THE ENTRY DOOR SHALL BE ADJUSTED TO CLOSE FROM AN OPEN POSITION OF 90° TO AN OPEN POSITION OF 12° IN NOT LESS THAN 5 SECONDS.

OPENING FORCE OF ALL SWINGING INTERIOR DOORS AND THE SLIDING GLASS DOOR SHALL NOT EXCEED 5 POUNDS APPLIED TO THE LATCH SIDE OF THE DOOR.

THE FORCE REQUIRED TO ACTIVATE ALL OTHER OPERABLE ITEMS LISTED ABOVE SHALL BE 5 POUNDS.

*BIFOLD DOOR HARDWARE AT LAUNDRY TO BE 'FULL ACCESS HARDWARE'.

THE 30"x48" CLEAR FLOOR SPACE IS REQUIRED AT EACH FIXTURE OR LOCATION SHOWN ON THE FLOOR PLAN.

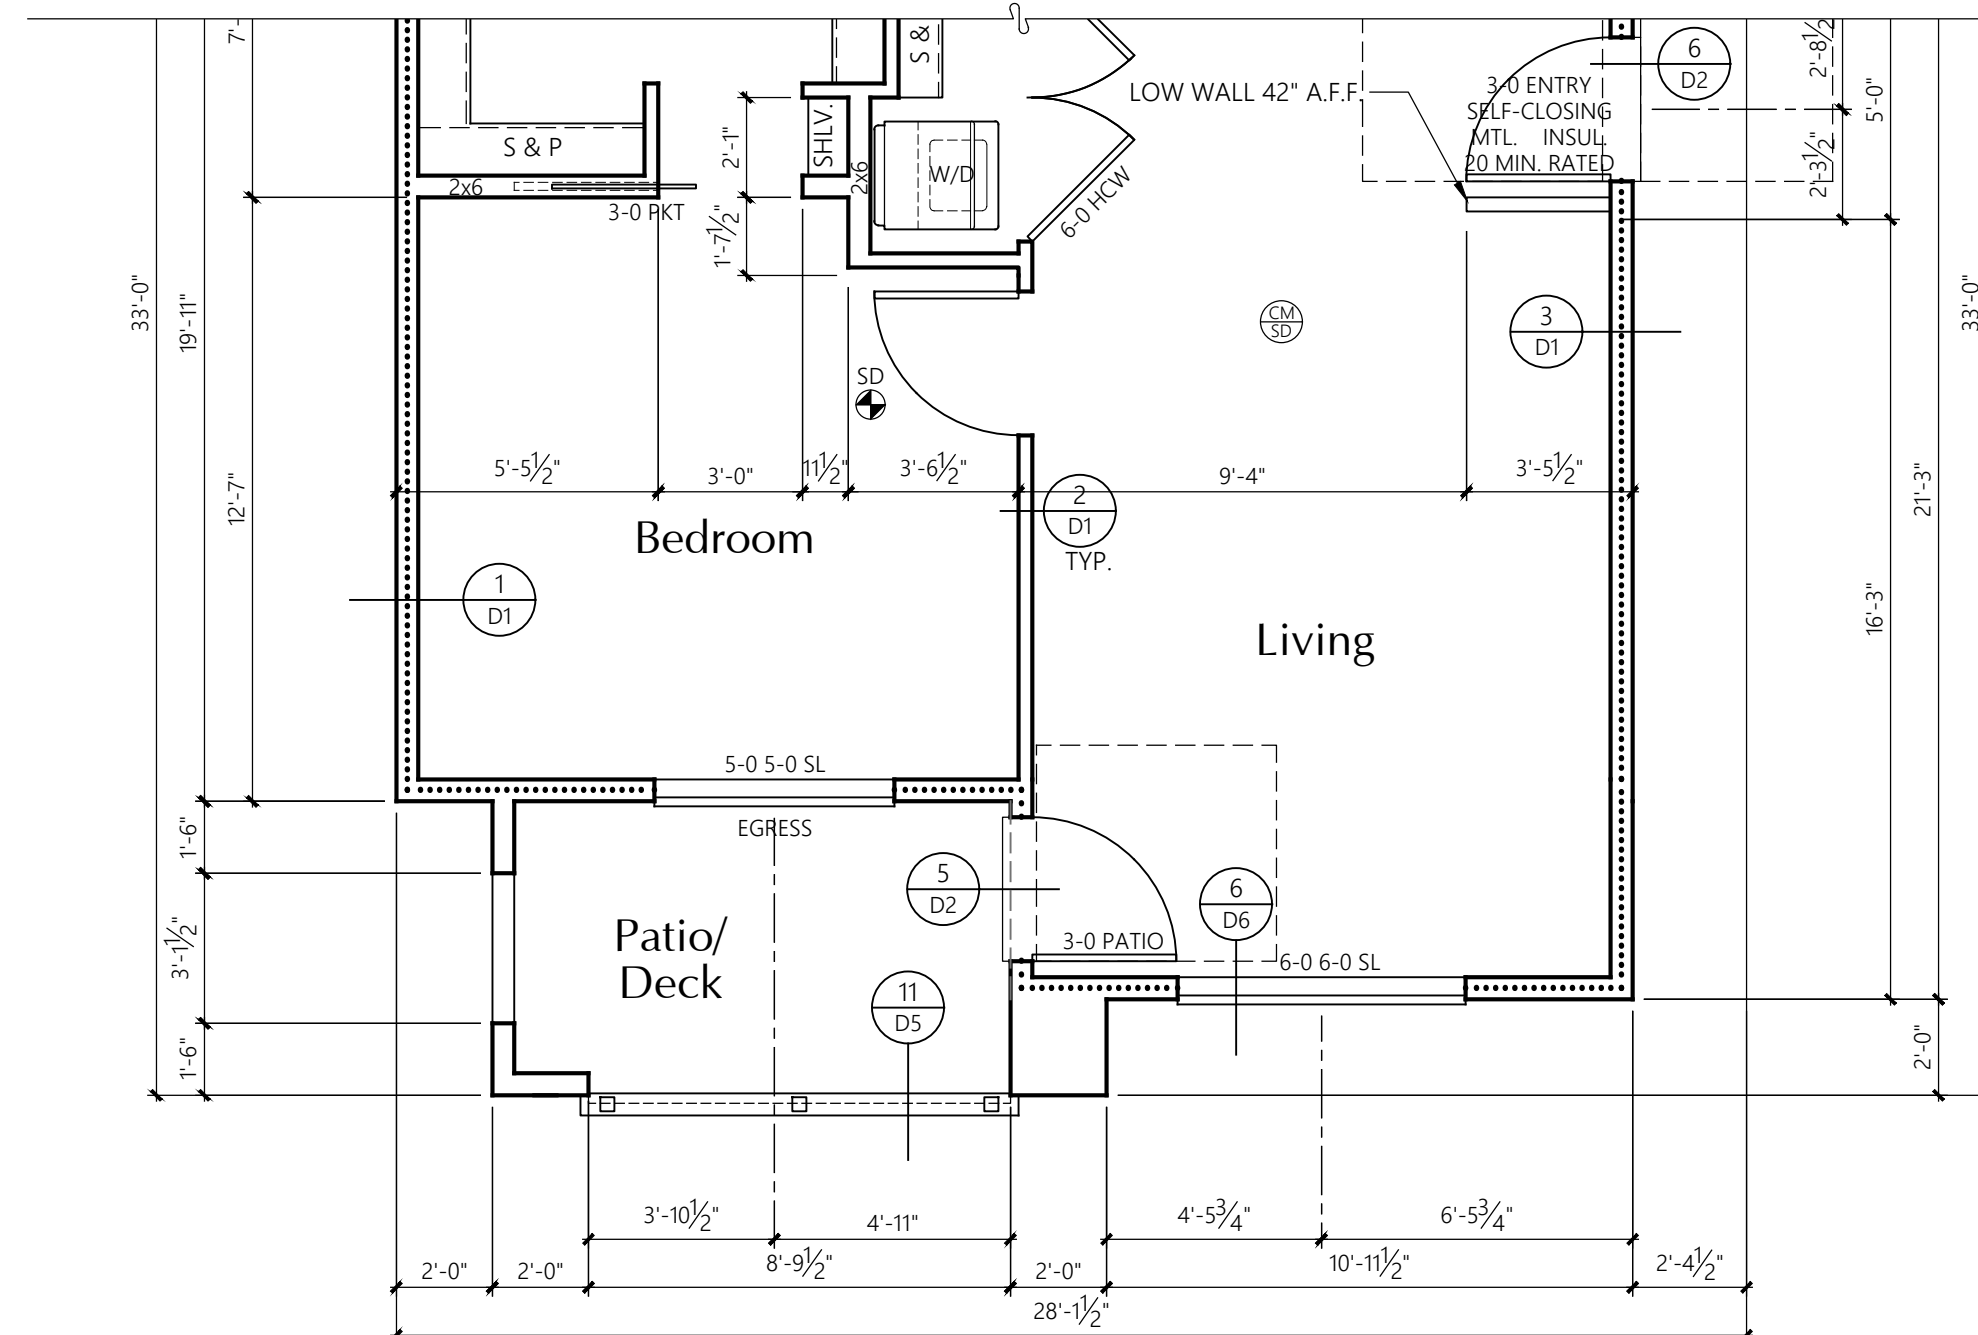

1-BED-END UNIT

1/4" = 1'-0"

TYPE 'B' ACCESSIBLE
BASEMENT FLOOR PLAN


SEE TYPICAL 1-BED-END UNIT TYPE 'B' ACCESSIBLE FLOOR PLAN FOR REMAINDER OF UNIT

Bradley Heights Apartments
Puyallup, Wa

Timberlane Partners

Revisions
No. Date Description


Initial Publish Date:
Date Plotted: 2-20-24
Job No.: 23-06
Drawn By: APT/HDM
Sheet No.:

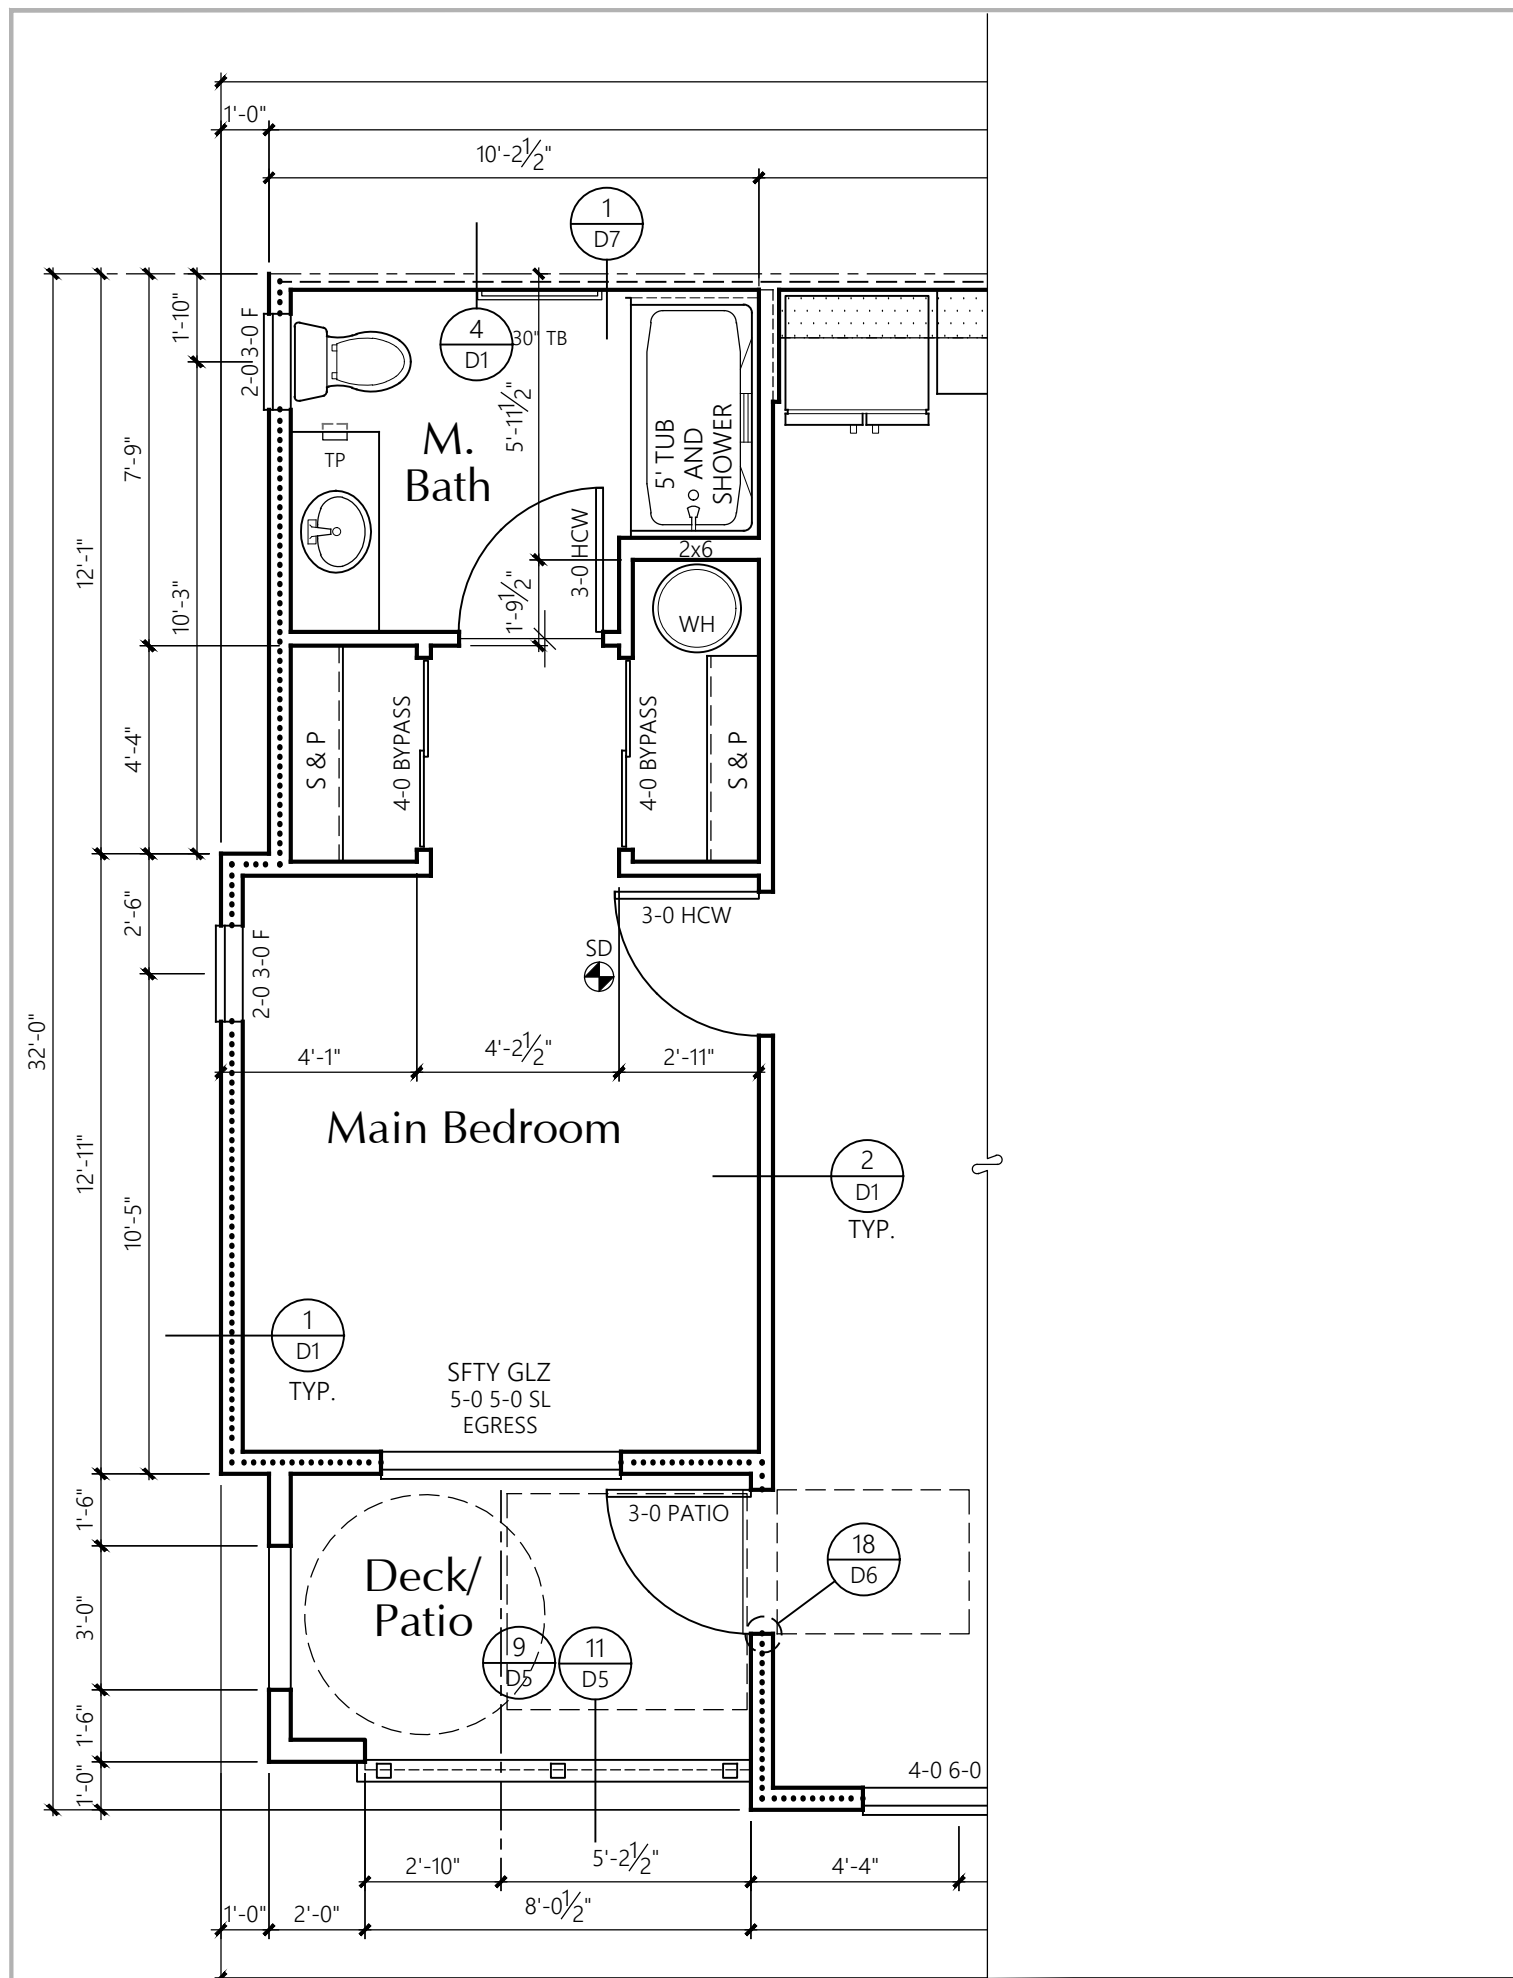

2-BED-ALT UNIT ALTERNATE TYPE 'A' OR 'B' ACCESSIBLE
1st LEVEL FLOOR PLAN

1/4" = 1'-0"


SEE TYPICAL 2-BED UNIT TYPE 'A' ACCESSIBLE FLOOR PLAN OR TYPE 'B' ACCESSIBLE FLOOR PLAN FOR REMAINDER OF UNIT

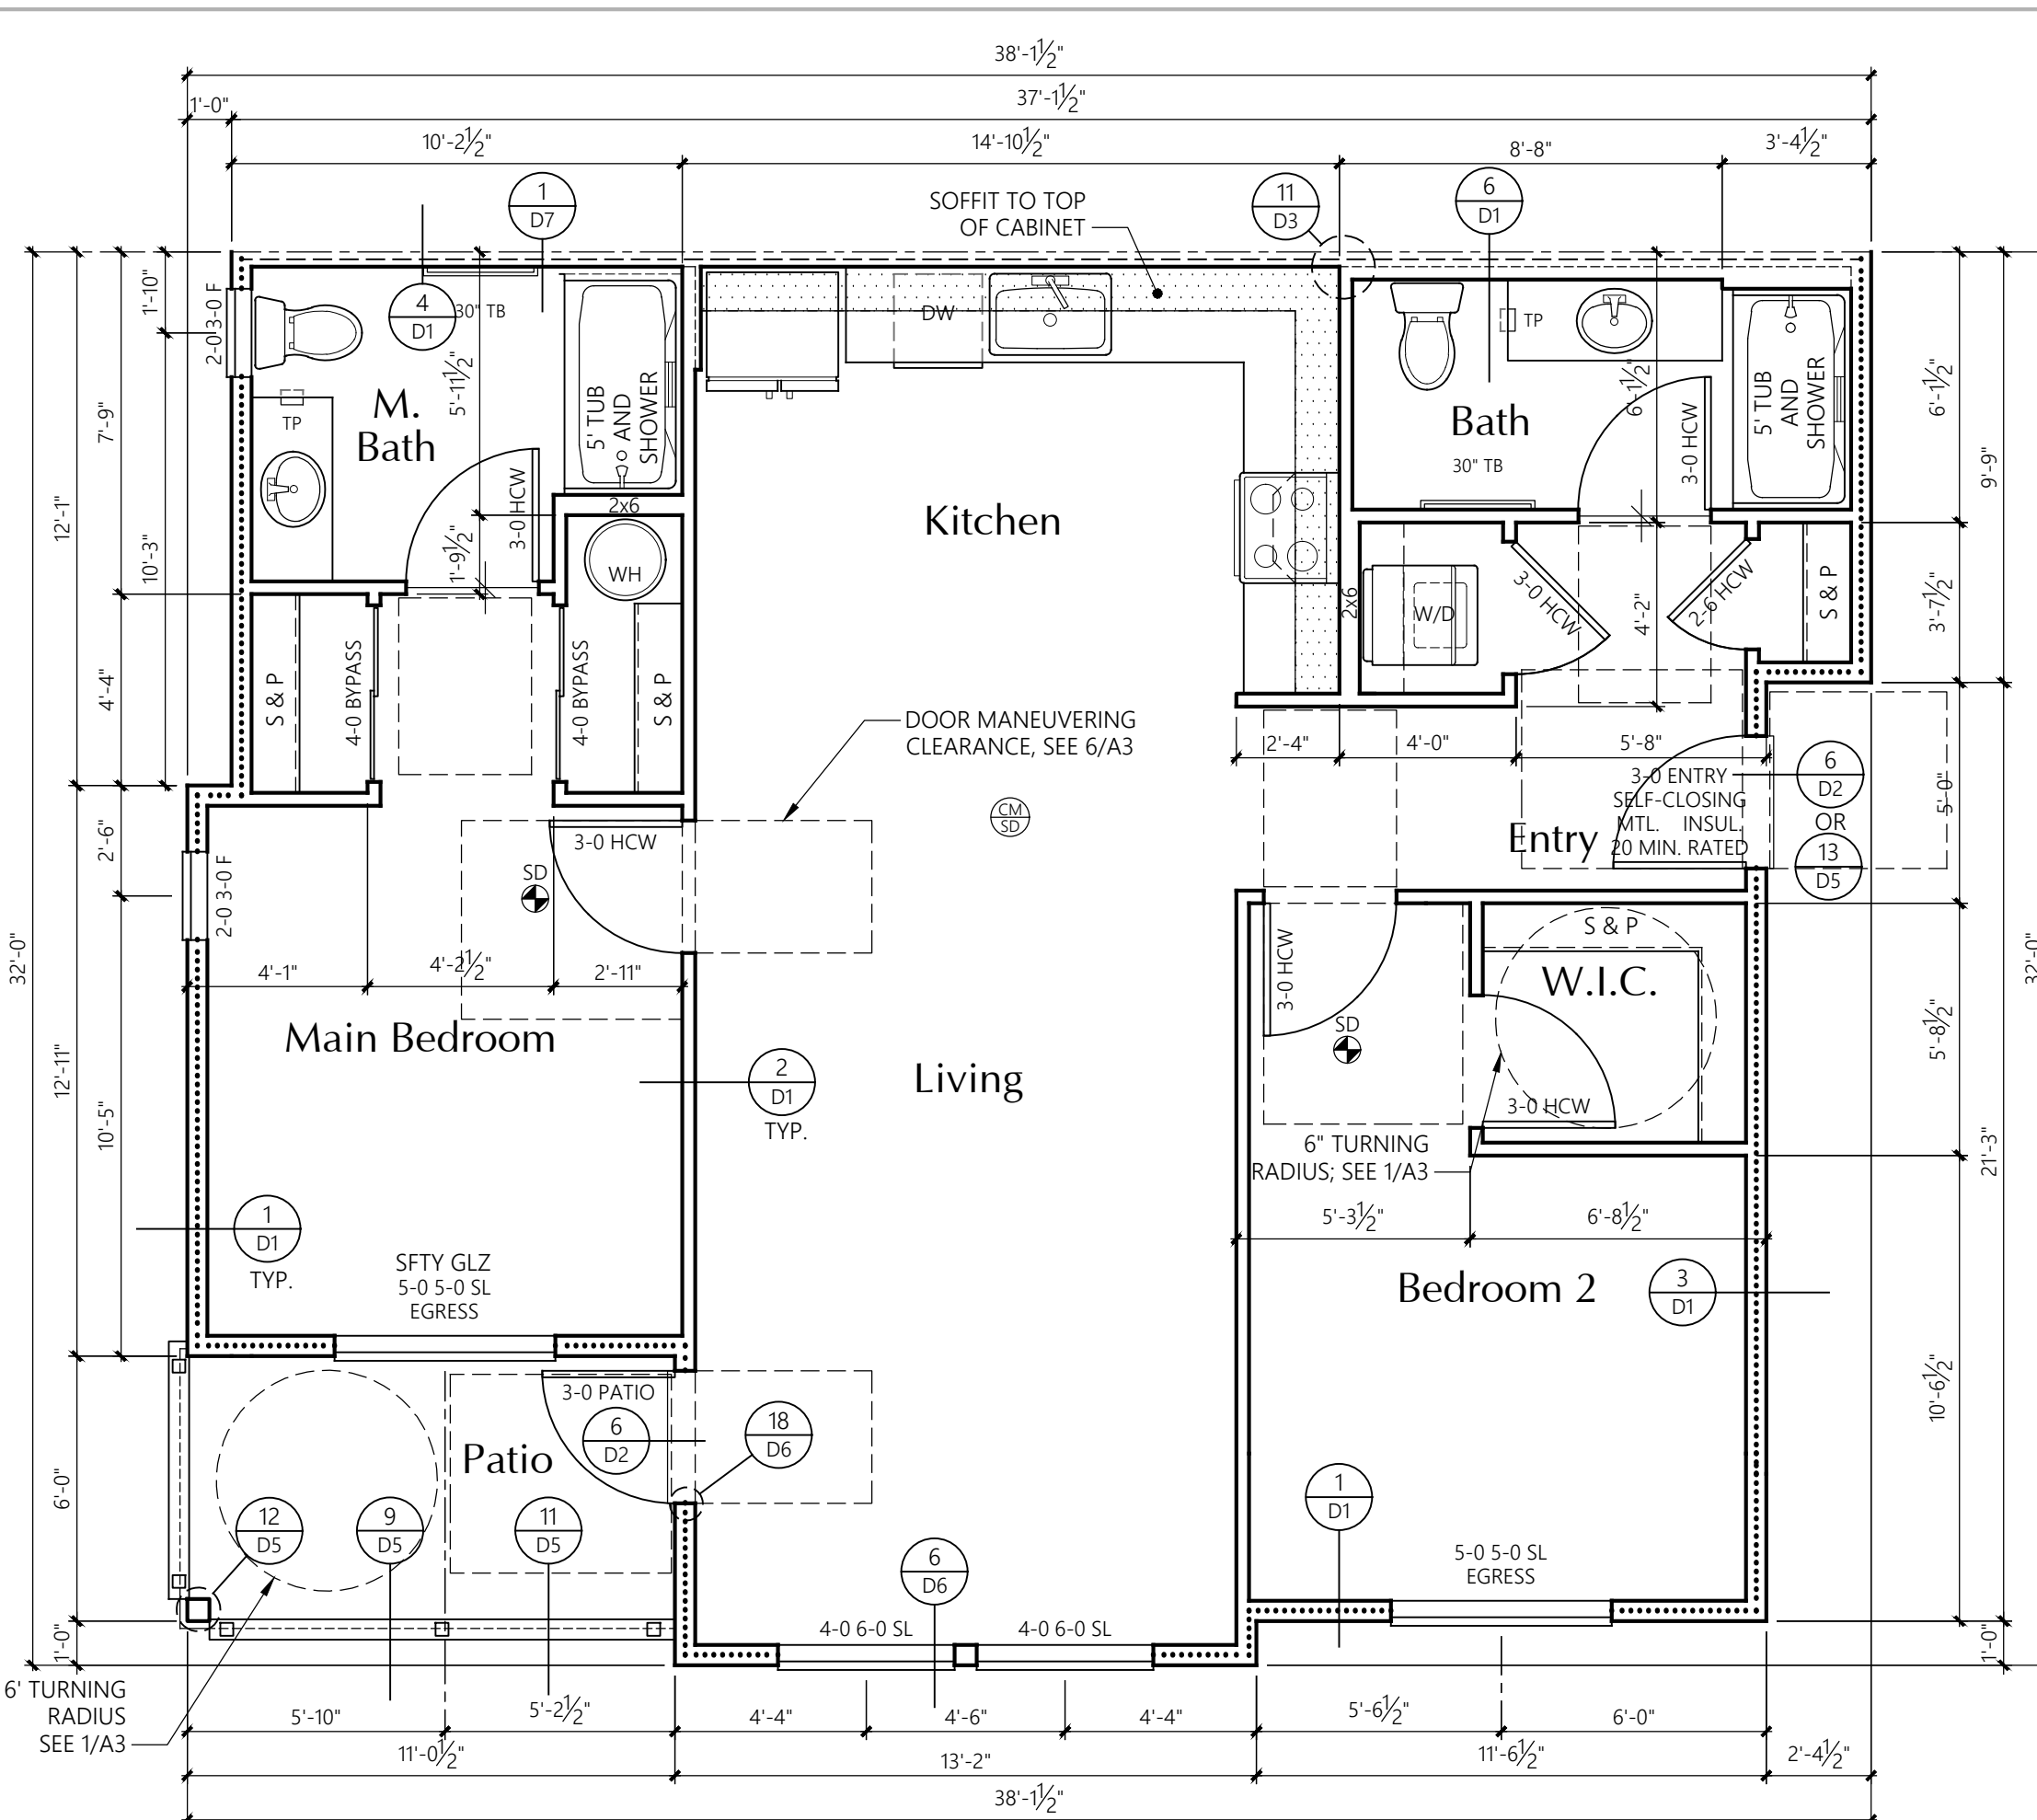

2 BED UNIT TYPE 'A' ACCESSIBLE
1st LEVEL FLOOR PLAN

1/4" = 1'-0"


AREA SUMMARY		
	Heated SF	Patio/Deck SF
Total SF	1019	66

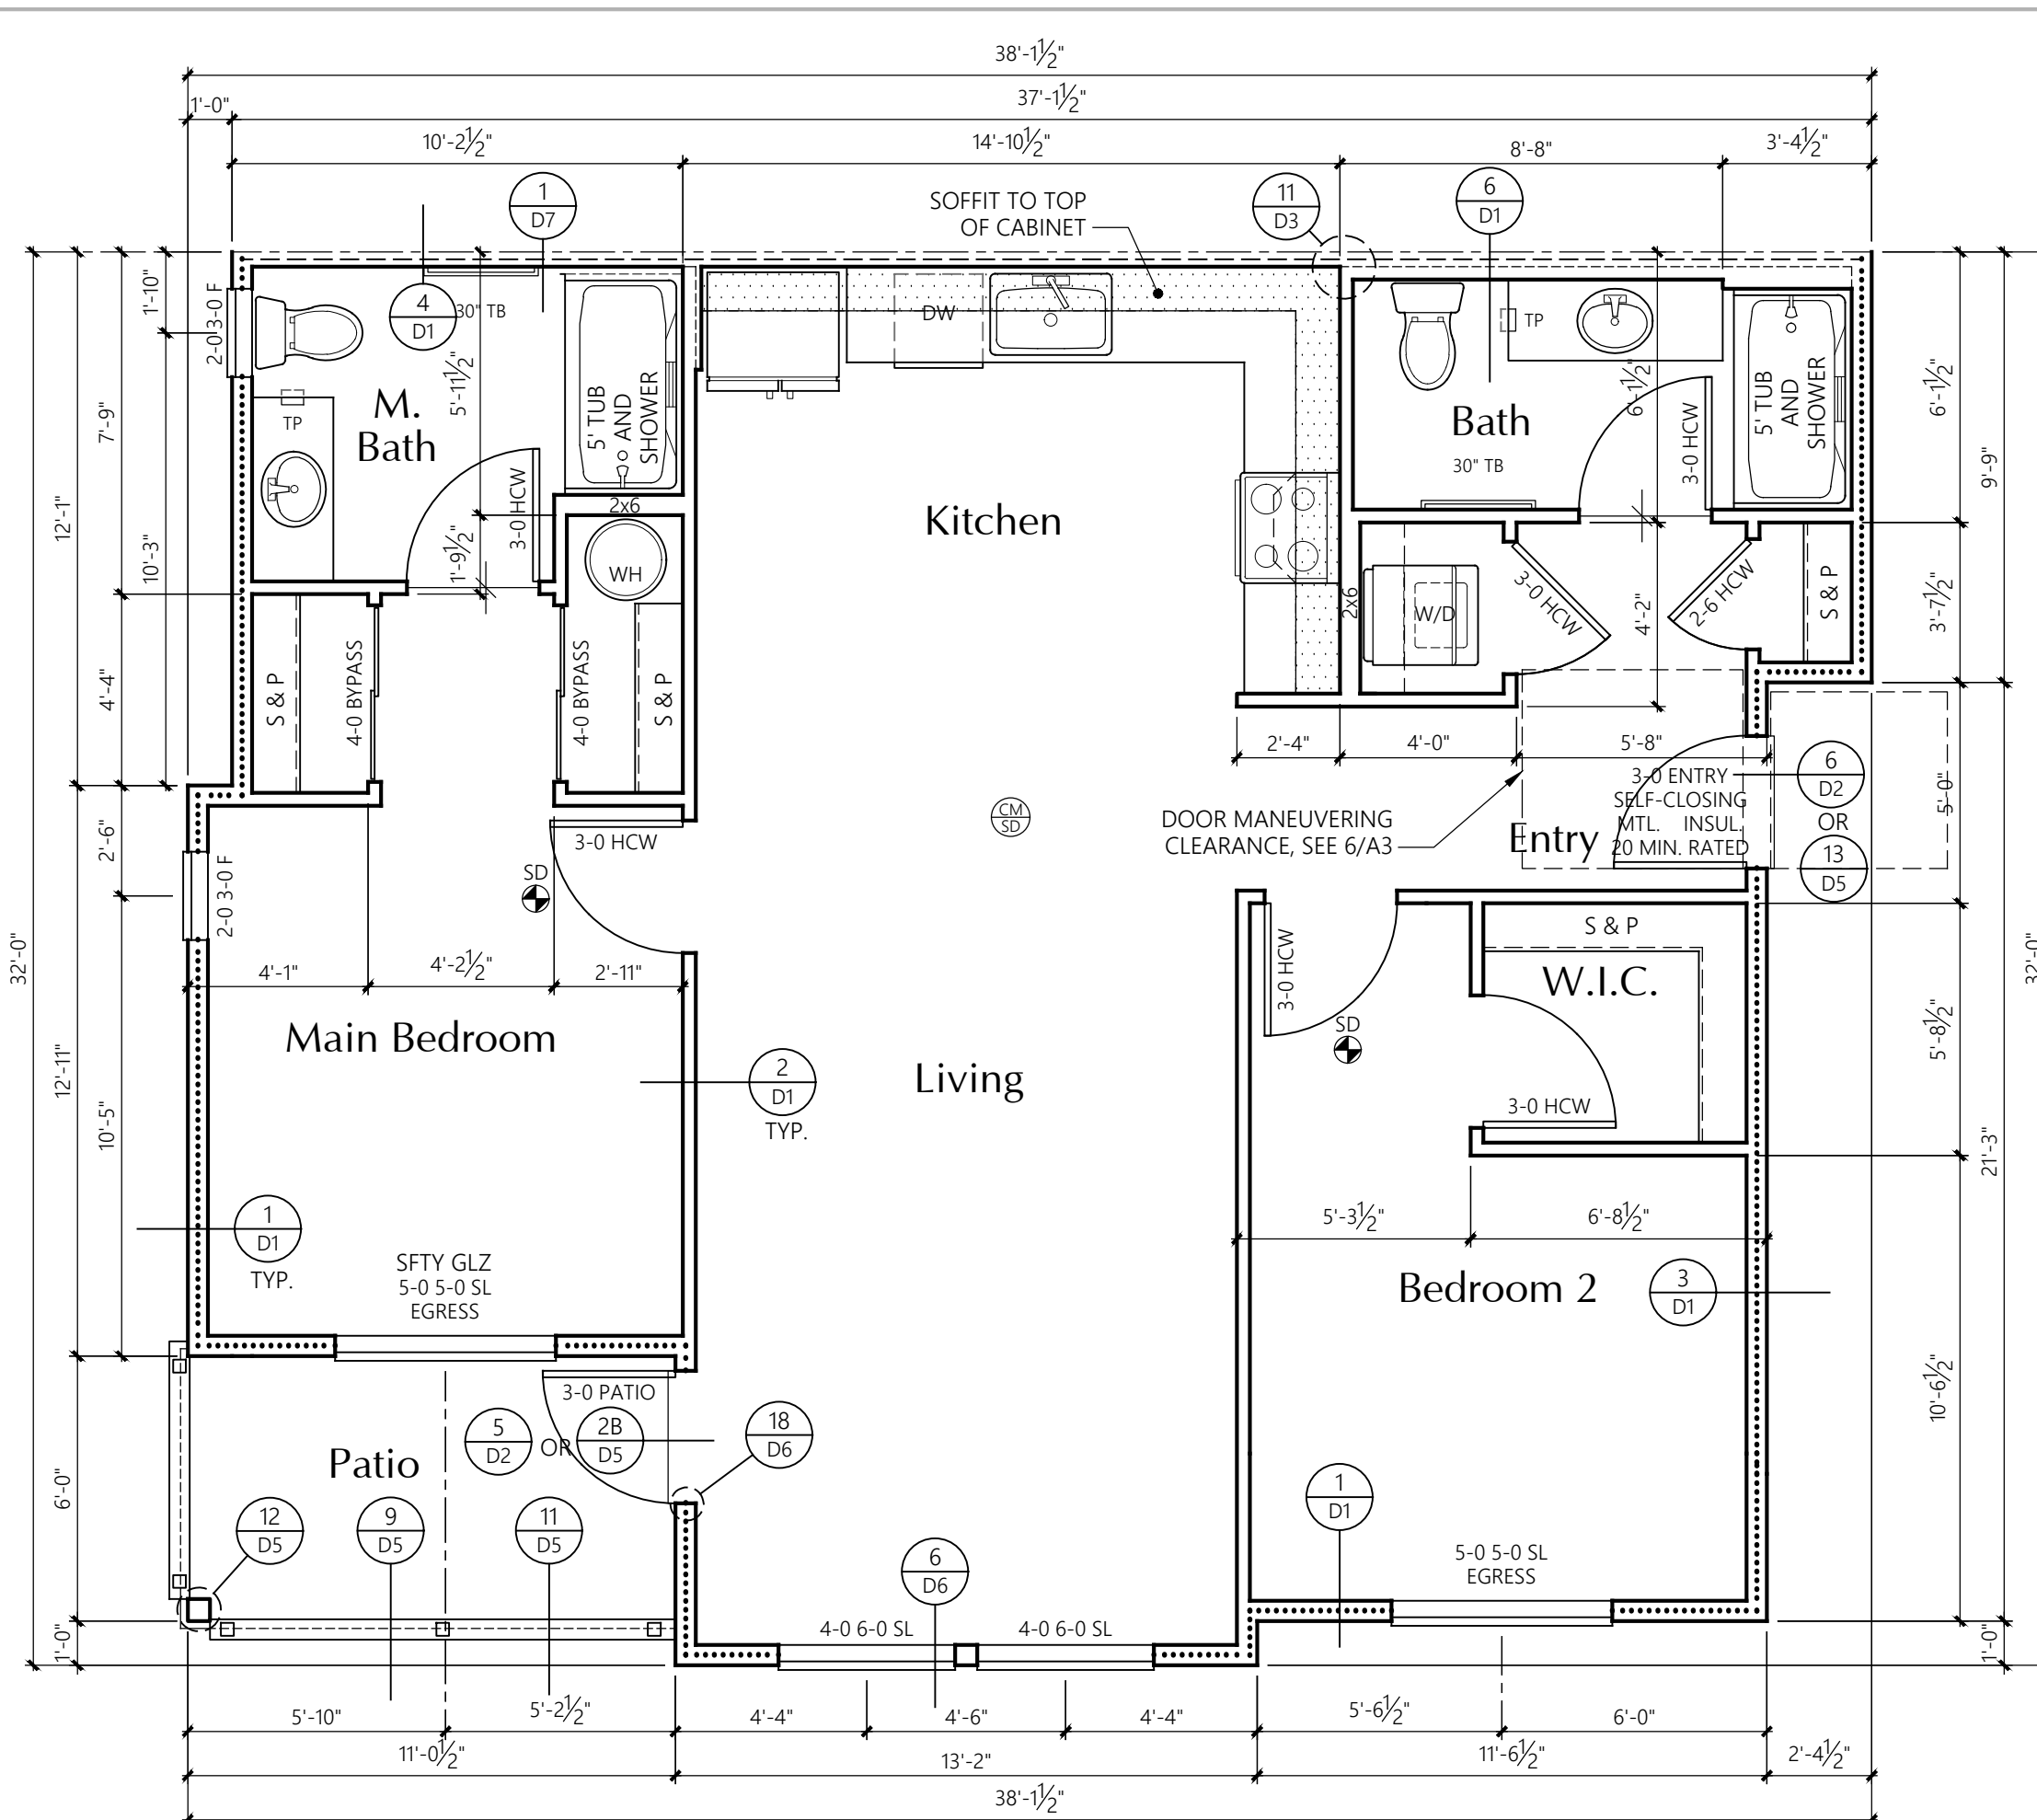

2-BED UNIT TYPE 'B' ACCESSIBLE
1st LEVEL FLOOR PLAN

1/4" = 1'-0"

AREA SUMMARY		
	Heated SF	Patio/Deck SF
Total SF	1019	66

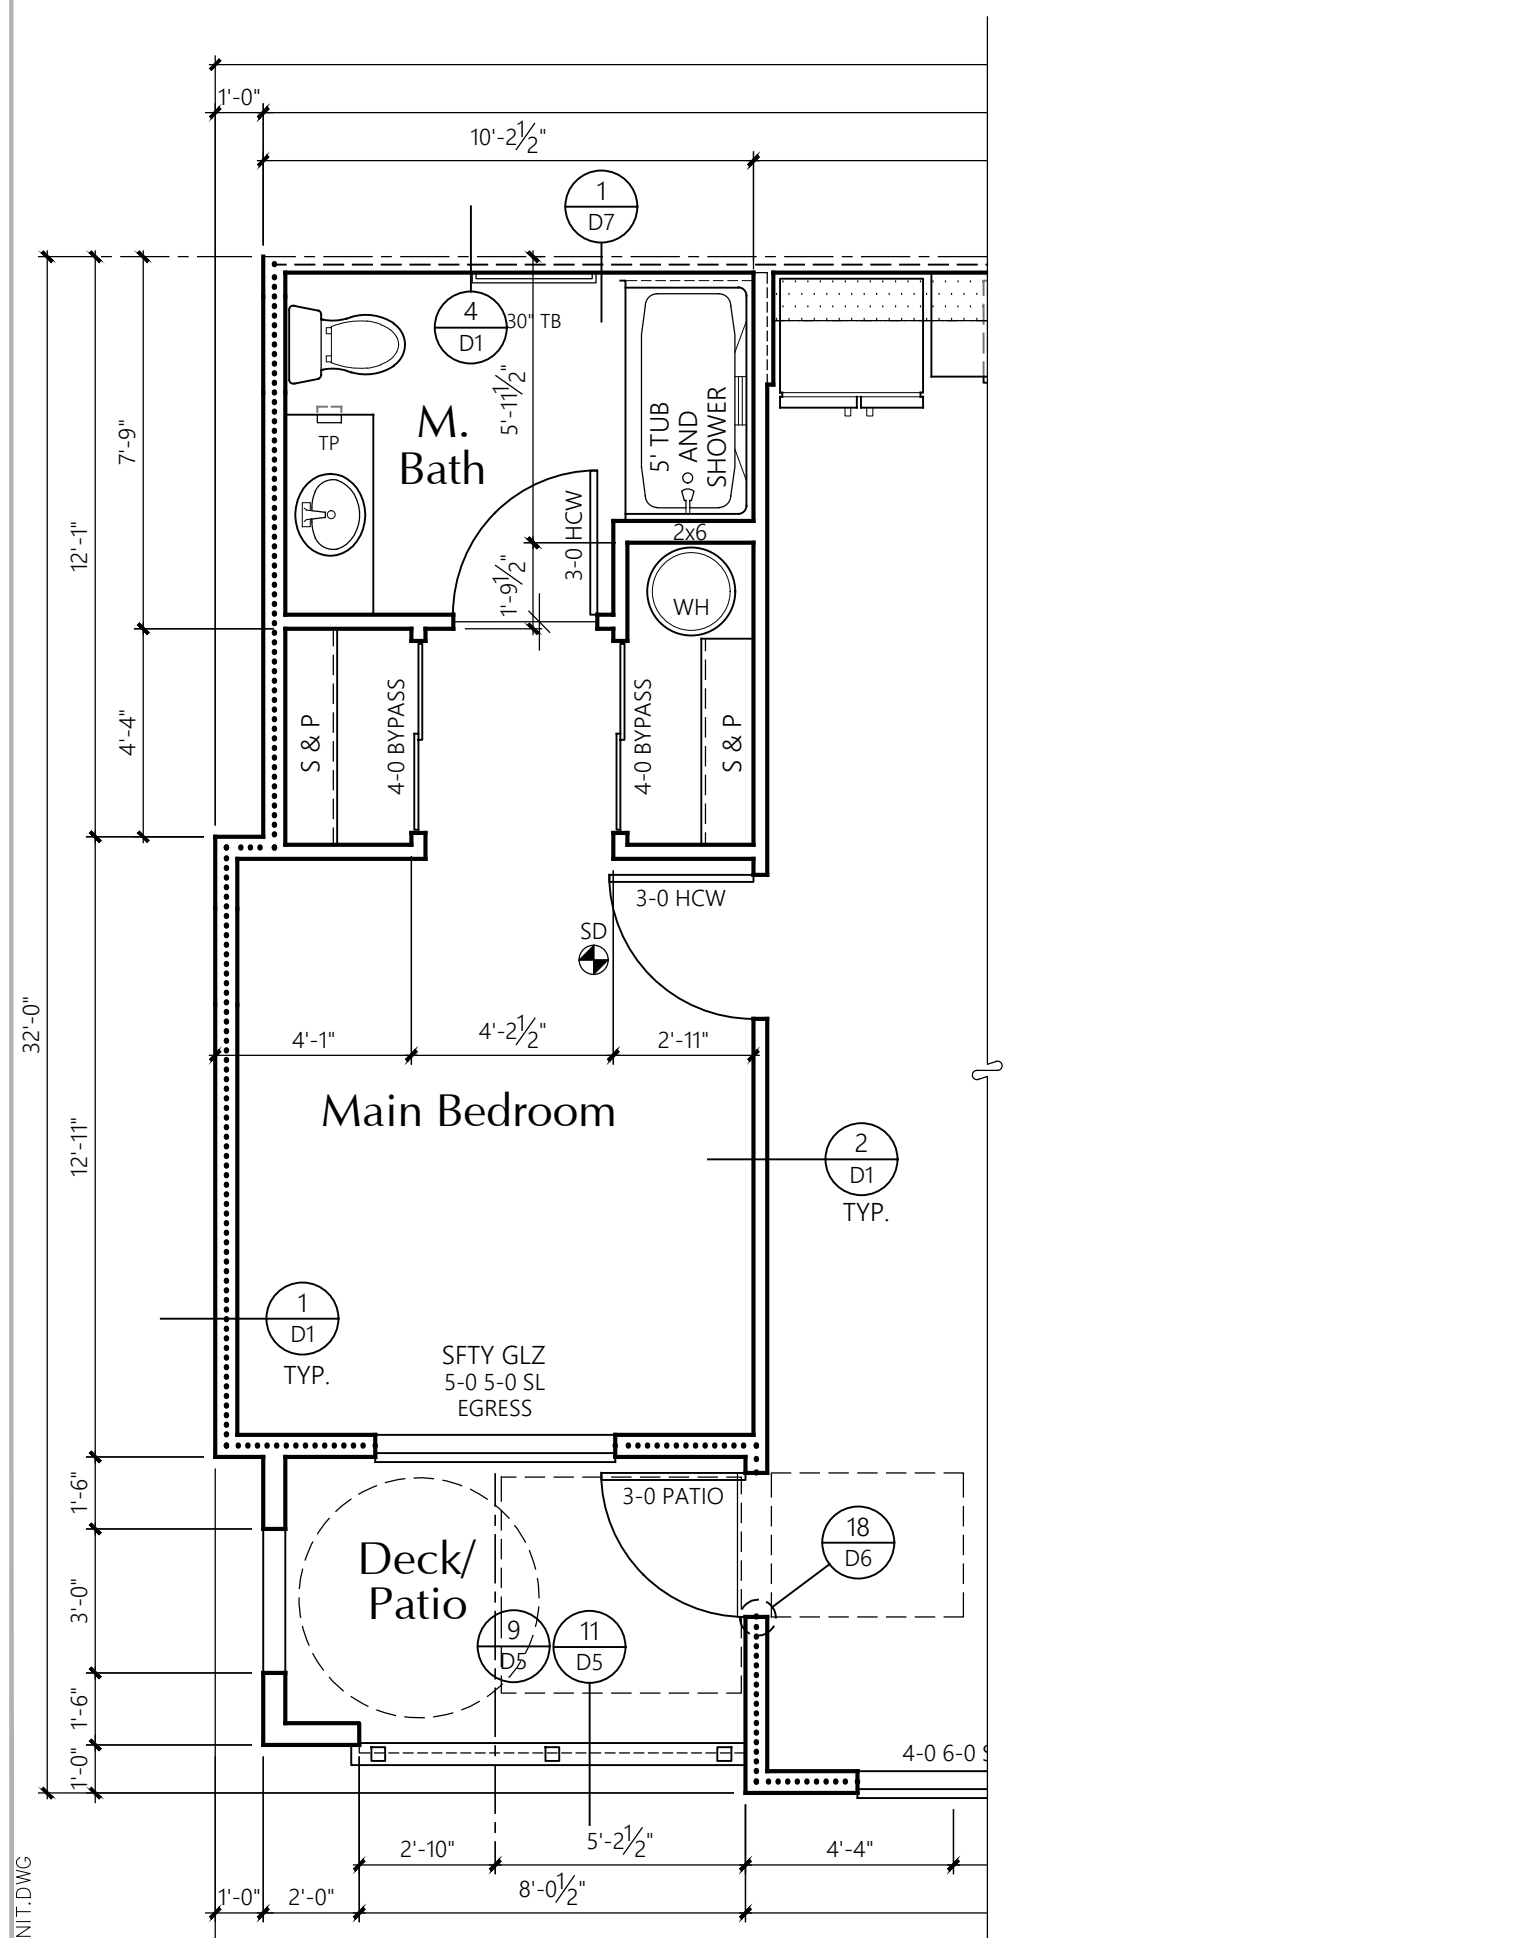

2-BED-ALT UNIT ALT. 'A' OR 'B' ACCESSIBLE
BASEMENT PLAN

1/4" = 1'-0"

SEE TYPICAL 2-BED UNIT TYPE 'A' ACCESSIBLE FLOOR PLAN OR TYPE 'B' ACCESSIBLE FLOOR PLAN FOR REMAINDER OF UNIT

UNIT PLAN NOTES

- FRAMING: 2x6'S AT EXTERIOR WALLS
2x4'S AT INTERIOR WALLS
UNLESS NOTED OTHERWISE.
 - R-21 BATT INSULATION U.N.O.
 - R-13 BATT INSULATION
 - 3/8" ACOUSTICAL INSULATION ONE SIDE OF PARTYWALL, U.N.O.
 - LOCATION OF SOFFIT FOR VENT RUNS, SOFFIT HEIGHT +8'-0" A.F.F. U.N.O. ON PLANS; SEE DETAIL 1/D7
 - SMOKE DETECTOR
 - CARBON MONOXIDE/SMOKE DETECTOR
- CONCEALED SPACES SHALL BE FIRESTOPPED IN BOTH DIRECTIONS AT 10'-0" ON CENTER AND AT FLOORS. TYPICAL.
- ALL ESCAPE OR RESCUE WINDOWS FROM SLEEPING ROOMS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE FEET. THE MINIMUM CLEAR OPENING HEIGHT DIMENSION SHALL BE 24". MINIMUM CLEAR OPENING WIDTH DIMENSION SHALL BE 20". EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE THE BOTTOM OF CLEAR OPENING NOT GREATER THAN 44 INCHES MEASURED FROM THE FLOOR.
- WHERE THE OPENING OF THE SILL PORTION OF AN OPERABLE WINDOW IS LOCATED MORE THAN 72 INCHES ABOVE THE FINISHED GRADE OR OTHER SURFACE BELOW, THE LOWEST PART OF THE CLEAR OPENING OF THE WINDOW SHALL BE AT A HEIGHT NOT LESS THAN 36 INCHES ABOVE THE FINISHED FLOOR SURFACE OF THE ROOM IN WHICH THE WINDOW IS LOCATED. OPERABLE SECTIONS OF WINDOWS SHALL NOT PERMIT OPENINGS THAT ALLOW PASSAGE OF A 4 INCH DIAMETER SPHERE WHERE SUCH OPENINGS ARE LOCATED WITHIN 36 INCHES OF THE FINISHED FLOOR.
- ALL GLAZING SHALL CONFORM TO THE 2018 IBC, CHAPTER 24, SEC. 2406, SAFETY GLAZING. GLAZING IN ALL DOORS SHALL BE SAFETY TYPE AND ALL GLAZING WITHIN A 24" ARC OF EITHER VERTICAL EDGE SHALL BE SAFETY TYPE.
- PROVIDE 3/8" TYPE 'X' (MIN.) GYPSUM SHEATHING ON WALLS BEHIND TUB/SHOWERS TO SATISFY FIRE REQUIREMENTS AT PARTYWALL CONDITION. PROVIDE 3/4" PLYWOOD UNDER TUB IN PLACE OF THE GYPCRETE, SEE DETAIL 14/D1
- PROVIDE WATER RESISTANT GYPSUM WALLBOARD BEHIND TUB AND SHOWER ENCLOSURE MATERIALS TO A HEIGHT OF 70" MINIMUM ABOVE THE DRAIN INLET.
- NO PLUMBING SHALL BE LOCATED IN THE 1" AIR SPACE OF FIRE PARTITIONS OR FIRE WALLS.
- ALL BEDROOM AND BATHROOM DOORS SHALL BE UNDERCUT A MINIMUM OF 1/2" ABOVE THE ADJACENT FLOOR COVERING.
- THE FRONT DOOR SHALL BE OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE OR EFFORT. IT MAY BE PROVIDED WITH A NIGHT LATCH, DEAD BOLT OR SECURITY CHAIN. PROVIDED SUCH DEVICES ARE OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR TOOL, AND MOUNTED NOT TO EXCEED 48" ABOVE THE FINISHED FLOOR.

GYPSUM WALLBOARD SCHEDULE

EXCEPT WHERE NOTED OTHERWISE, 5/8" TYPE 'X' GYPSUM WALLBOARD SHALL BE USED THROUGHOUT.

ON INTERIOR NON-RATED WALLS, EXTERIOR WALLS, CORRIDOR WALLS, AND 1-HOUR AND 2-HOUR FIRE-RATED WALLS.

STANDARD PLATE
HEIGHT: 9'-1"

SEE ELEVATION SHEETS FOR FLOOR TO FLOOR HEIGHTS

WINDOW HDR IS 8'-0"
UNLESS NOTED OTHERWISE

SEE SHEET U8 FOR INTERIOR ELEVATIONS AND ACCESSIBILITY REQUIREMENTS.

DOOR KEY:

- TYPE: SW = SWING
BF = BIFOLD
BP = BYPASS
- CONSTRUCTION: HCW = HOLLOW CORE WD.
SCW = SOLID CORE WD.
MTL = METAL
HM = HOLLOW METAL

WINDOW KEY:

- TYPE: FIX = FIXED/PICTURE
SL = SLIDER
SH = SINGLE HUNG
SGD = SLIDING GLASS DOOR

INSULATION


- FOUNDATION PERIMETER - R-10 RIGID INSULATION TO A DEPTH OF 24" OR TO TOP OF FOOTING AT HEATED PERIMETER
 - EXTERIOR WALLS: FIBERGLASS BATTS OR BLANKETS 2x6 WALLS - R21
 - FLOORS OVER UNHEATED SPACES - R30
 - ATTICS AND ROOF ASSEMBLIES - R-49
 - FULL HEIGHT OF UNCOMPRESSED INSULATION EXTENDS OVER THE WALL TOP PLATE AT THE EAVES
 - EXTERIOR DOORS: MAIN ENTRY U=0.20
ALL OTHERS U=0.40
 - WINDOWS: MILGARD VINYL
TYPE (VINYL) MODEL U-VALUE
 - SLIDING 6110 ARGON/LoE 0.24 or BETTER
 - FIXED 6310 ARGON/LoE 0.24 or BETTER
 - SINGLE HUNG 6210 ARGON/LoE 0.24 or BETTER
 - DBL. SLIDER 8125 ARGON/LoE 0.24 or BETTER
 - SGD 6610 ARGON/LoE 0.24 or BETTER
- NOTE: ALL CONCEALED OR EXPOSED INSULATION SHALL HAVE A FLAME SPREAD INDEX OF NOT MORE THAN 25 AND A SMOKE-DEVELOPED INDEX OF NOT MORE THAN 450

ACCESSIBILITY NOTES:

- ALL GROUND FLOOR UNITS IN THIS PROJECT MUST MEET THE ACCESSIBILITY REQUIREMENTS OF TYPE 'B' ACCESSIBLE UNITS AS REQUIRED BY CHAPTER 11 OF THE 2018 IBC.
- INCLUDED IN THE ABOVE GROUND FLOOR UNITS 5% OF ALL UNITS NEED TO MEET THE ACCESSIBILITY REQUIREMENTS OF TYPE 'A' ACCESSIBLE UNITS AS REQUIRED BY CHAPTER 11 OF THE 2018 IBC. SEE BUILDING PLANS FOR LOCATION OF 'TYPE A' UNITS
- SEE SHEET U9 FOR SPECIFIC ADAPTABILITY STANDARD FOR BOTH 'TYPE A' AND 'TYPE B' ACCESSIBLE UNITS. SEE INTERIOR ELEVATION SHEETS FOR ADDITIONAL ACCESSIBILITY REQUIREMENTS.
- LIGHTING CONTROLS, ELECTRICAL SWITCHES, ENVIRONMENTAL CONTROLS, OPERATING HARDWARE FOR DOORS AND WINDOWS, AND PLUMBING FIXTURE CONTROLS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING OR TWISTING OF THE WRIST TO OPERATE. EXCEPT FOR OPERABLE DOOR HARDWARE, SUCH ITEMS SHALL BE 15" MINIMUM AND 44" MAXIMUM ABOVE THE FLOOR (48" FOR WINDOWS).
- OPERABLE ENTRY DOOR HARDWARE SHALL BE 34" MINIMUM AND 48" MAXIMUM ABOVE THE FLOOR.
- OPENING FORCES FOR ENTRY DOOR SHALL BE: 15 POUNDS TO RELEASE THE LATCH
30 POUNDS TO SET DOOR IN MOTION
15 POUNDS TO OPEN DOOR TO FULL 90° FORCE MEASURED AT LATCH SIDE OF DOOR.
- THE DOOR CLOSER ON THE ENTRY DOOR SHALL BE ADJUSTED TO CLOSE FROM AN OPEN POSITION OF 90° TO AN OPEN POSITION OF 12° IN NOT LESS THAN 5 SECONDS.
- OPENING FORCE OF ALL SWINGING INTERIOR DOORS AND THE SLIDING GLASS DOOR SHALL NOT EXCEED 5 POUNDS APPLIED TO THE LATCH SIDE OF THE DOOR.
- THE FORCE REQUIRED TO ACTIVATE ALL OTHER OPERABLE ITEMS LISTED ABOVE SHALL BE 5 POUNDS.
- *BIFOLD DOOR HARDWARE AT LAUNDRY TO BE 'FULL ACCESS HARDWARE'.
- THE 30"x48" CLEAR FLOOR SPACE IS REQUIRED AT EACH FIXTURE OR LOCATION SHOWN ON THE FLOOR PLAN.

25 Central Way, Suite 210
Kirkland, Washington 98033
P: 425.454.7130 F: 425.658.1208
Web: www.milbrandtarch.com

© Copyright 2023
Milbrandt Architects, Inc., P.S.
All rights reserved

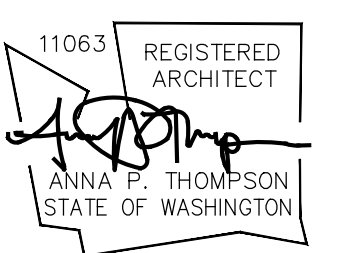


Bradley Heights Apartments
Puyallup, Wa

Timberlane Partners

Revisions

No.	Date	Description
-----	------	-------------

Initial Publish Date:
Date Plotted: **2-20-24**
Job No.: **23-06** Drawn By: **APT/HDM/TMK**
Sheet No.:

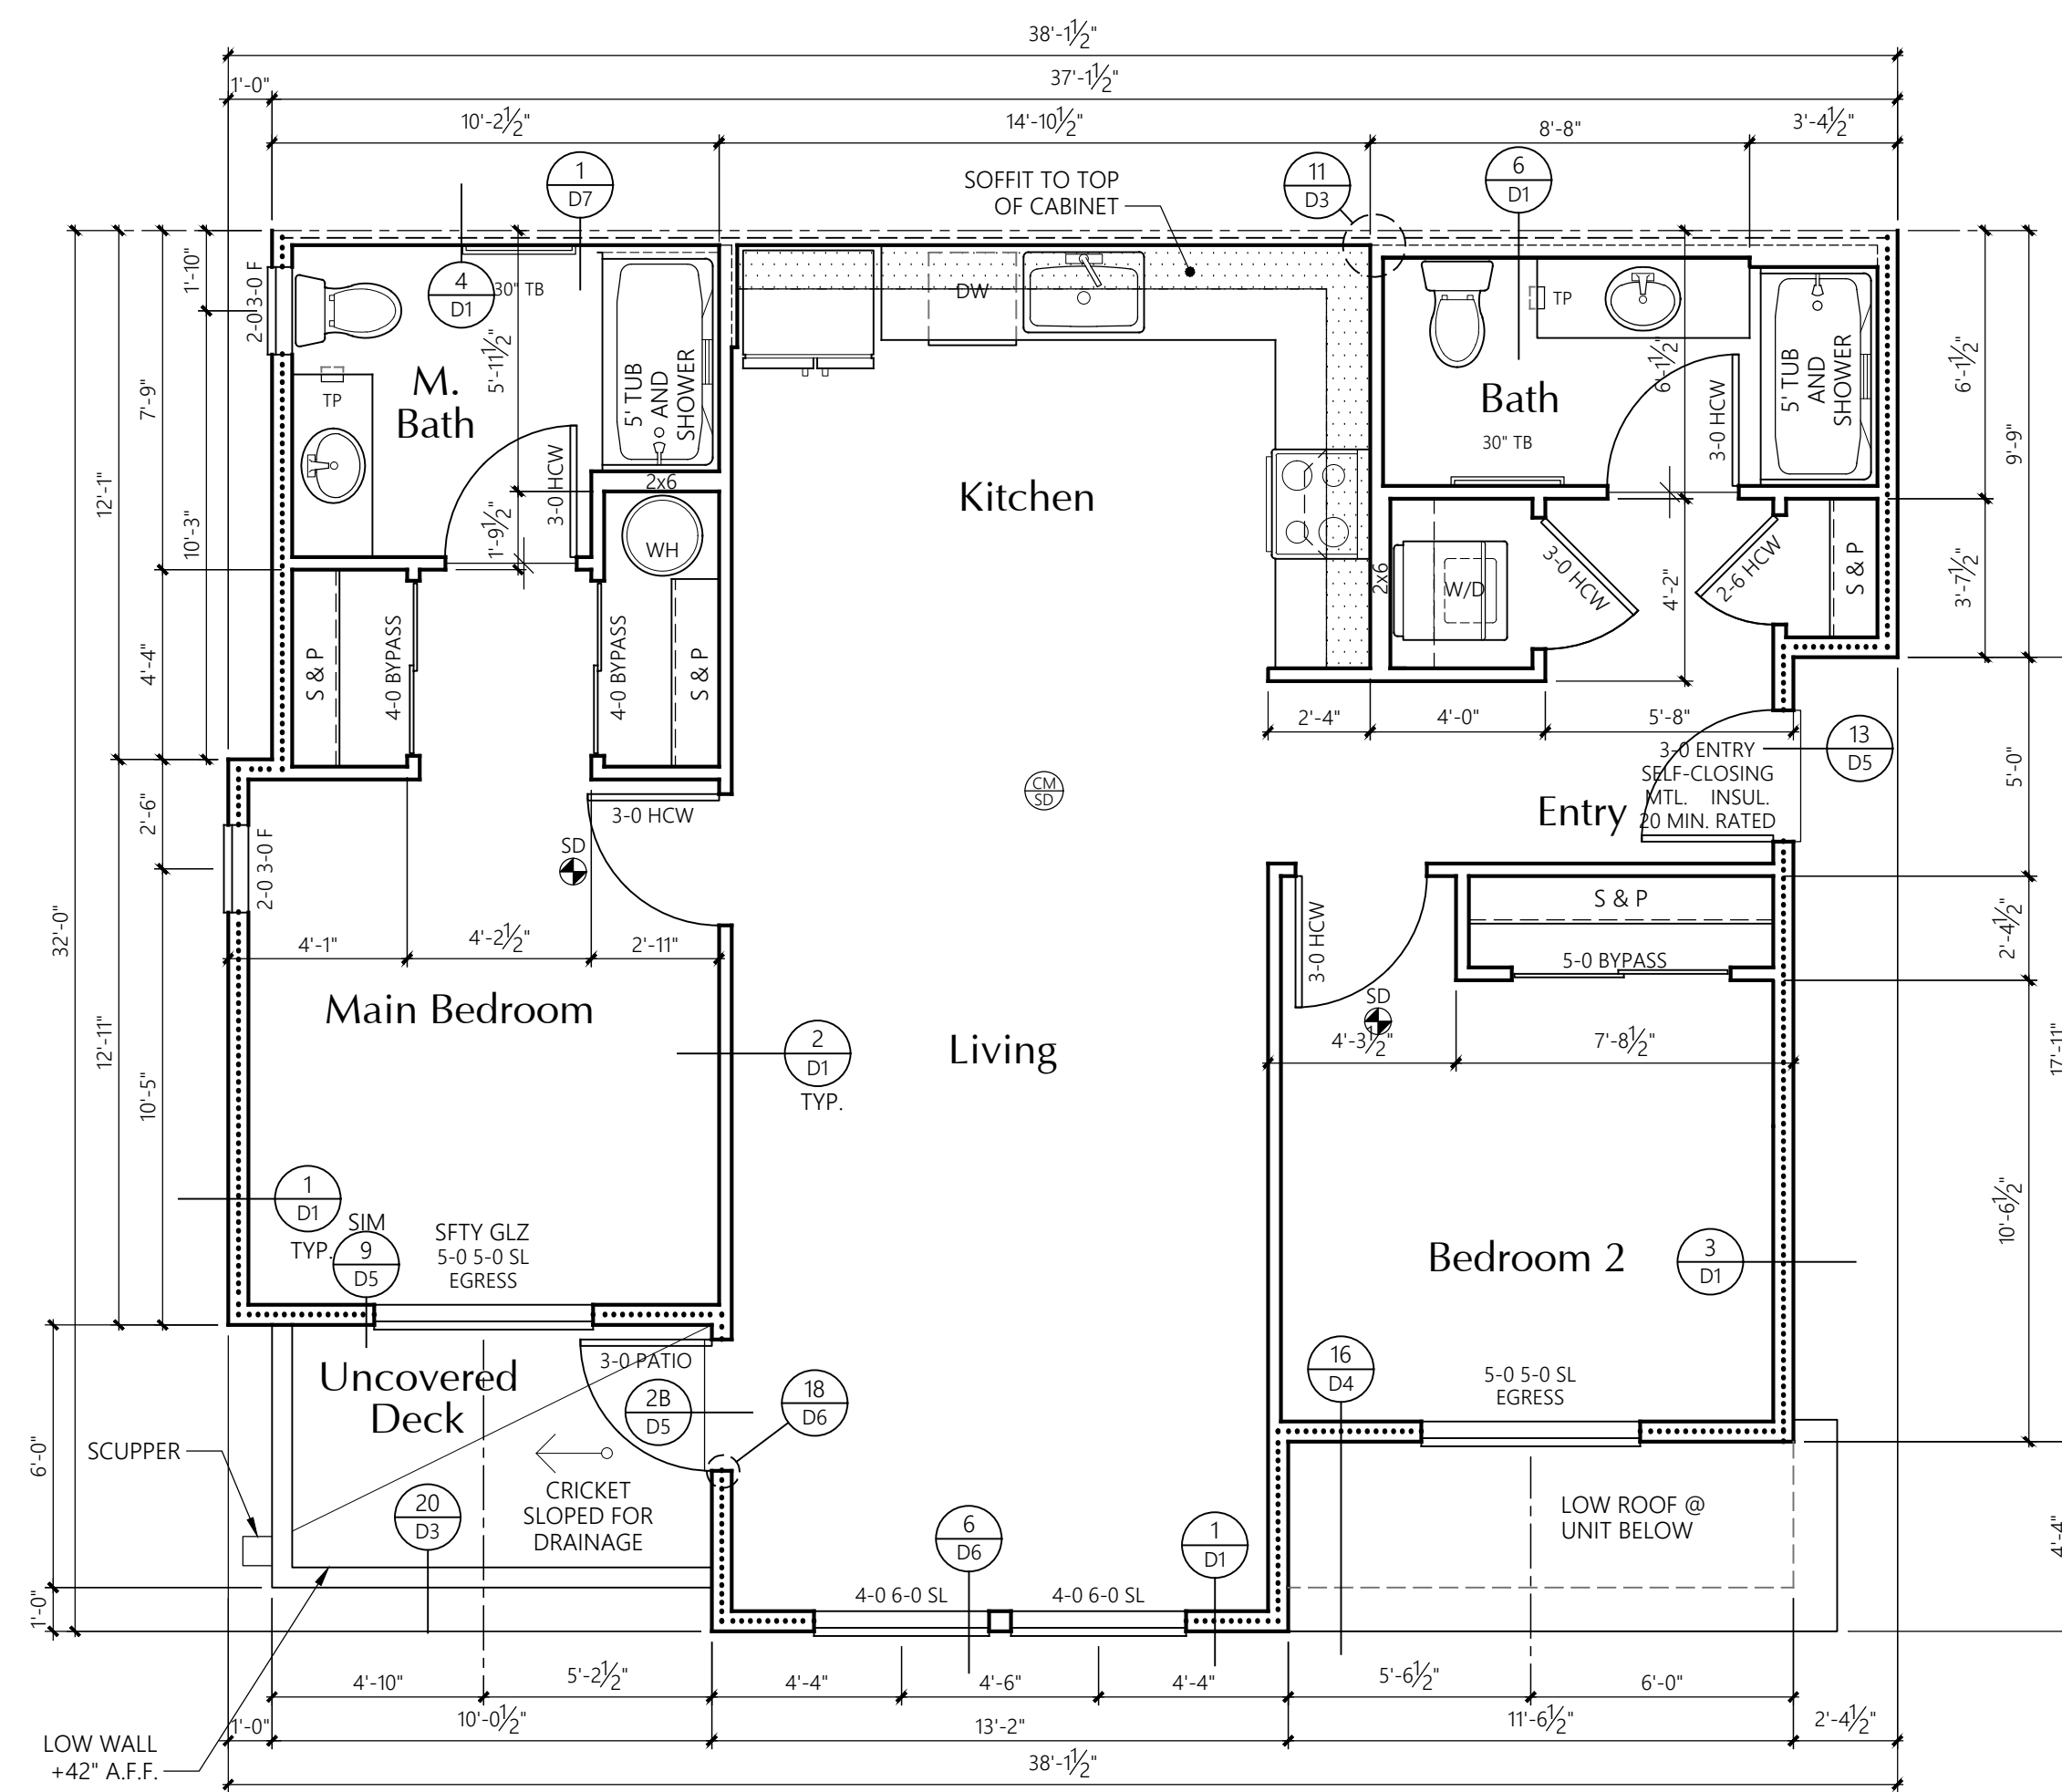


2-BED-ALT UNIT

1/4" = 1'-0"

ALTERNATE 3rd LEVEL FLOOR PLAN

AREA SUMMARY		
	Heated SF	Patio/Deck SF
Total SF	980	60

* Side of exterior walls to which area was measured

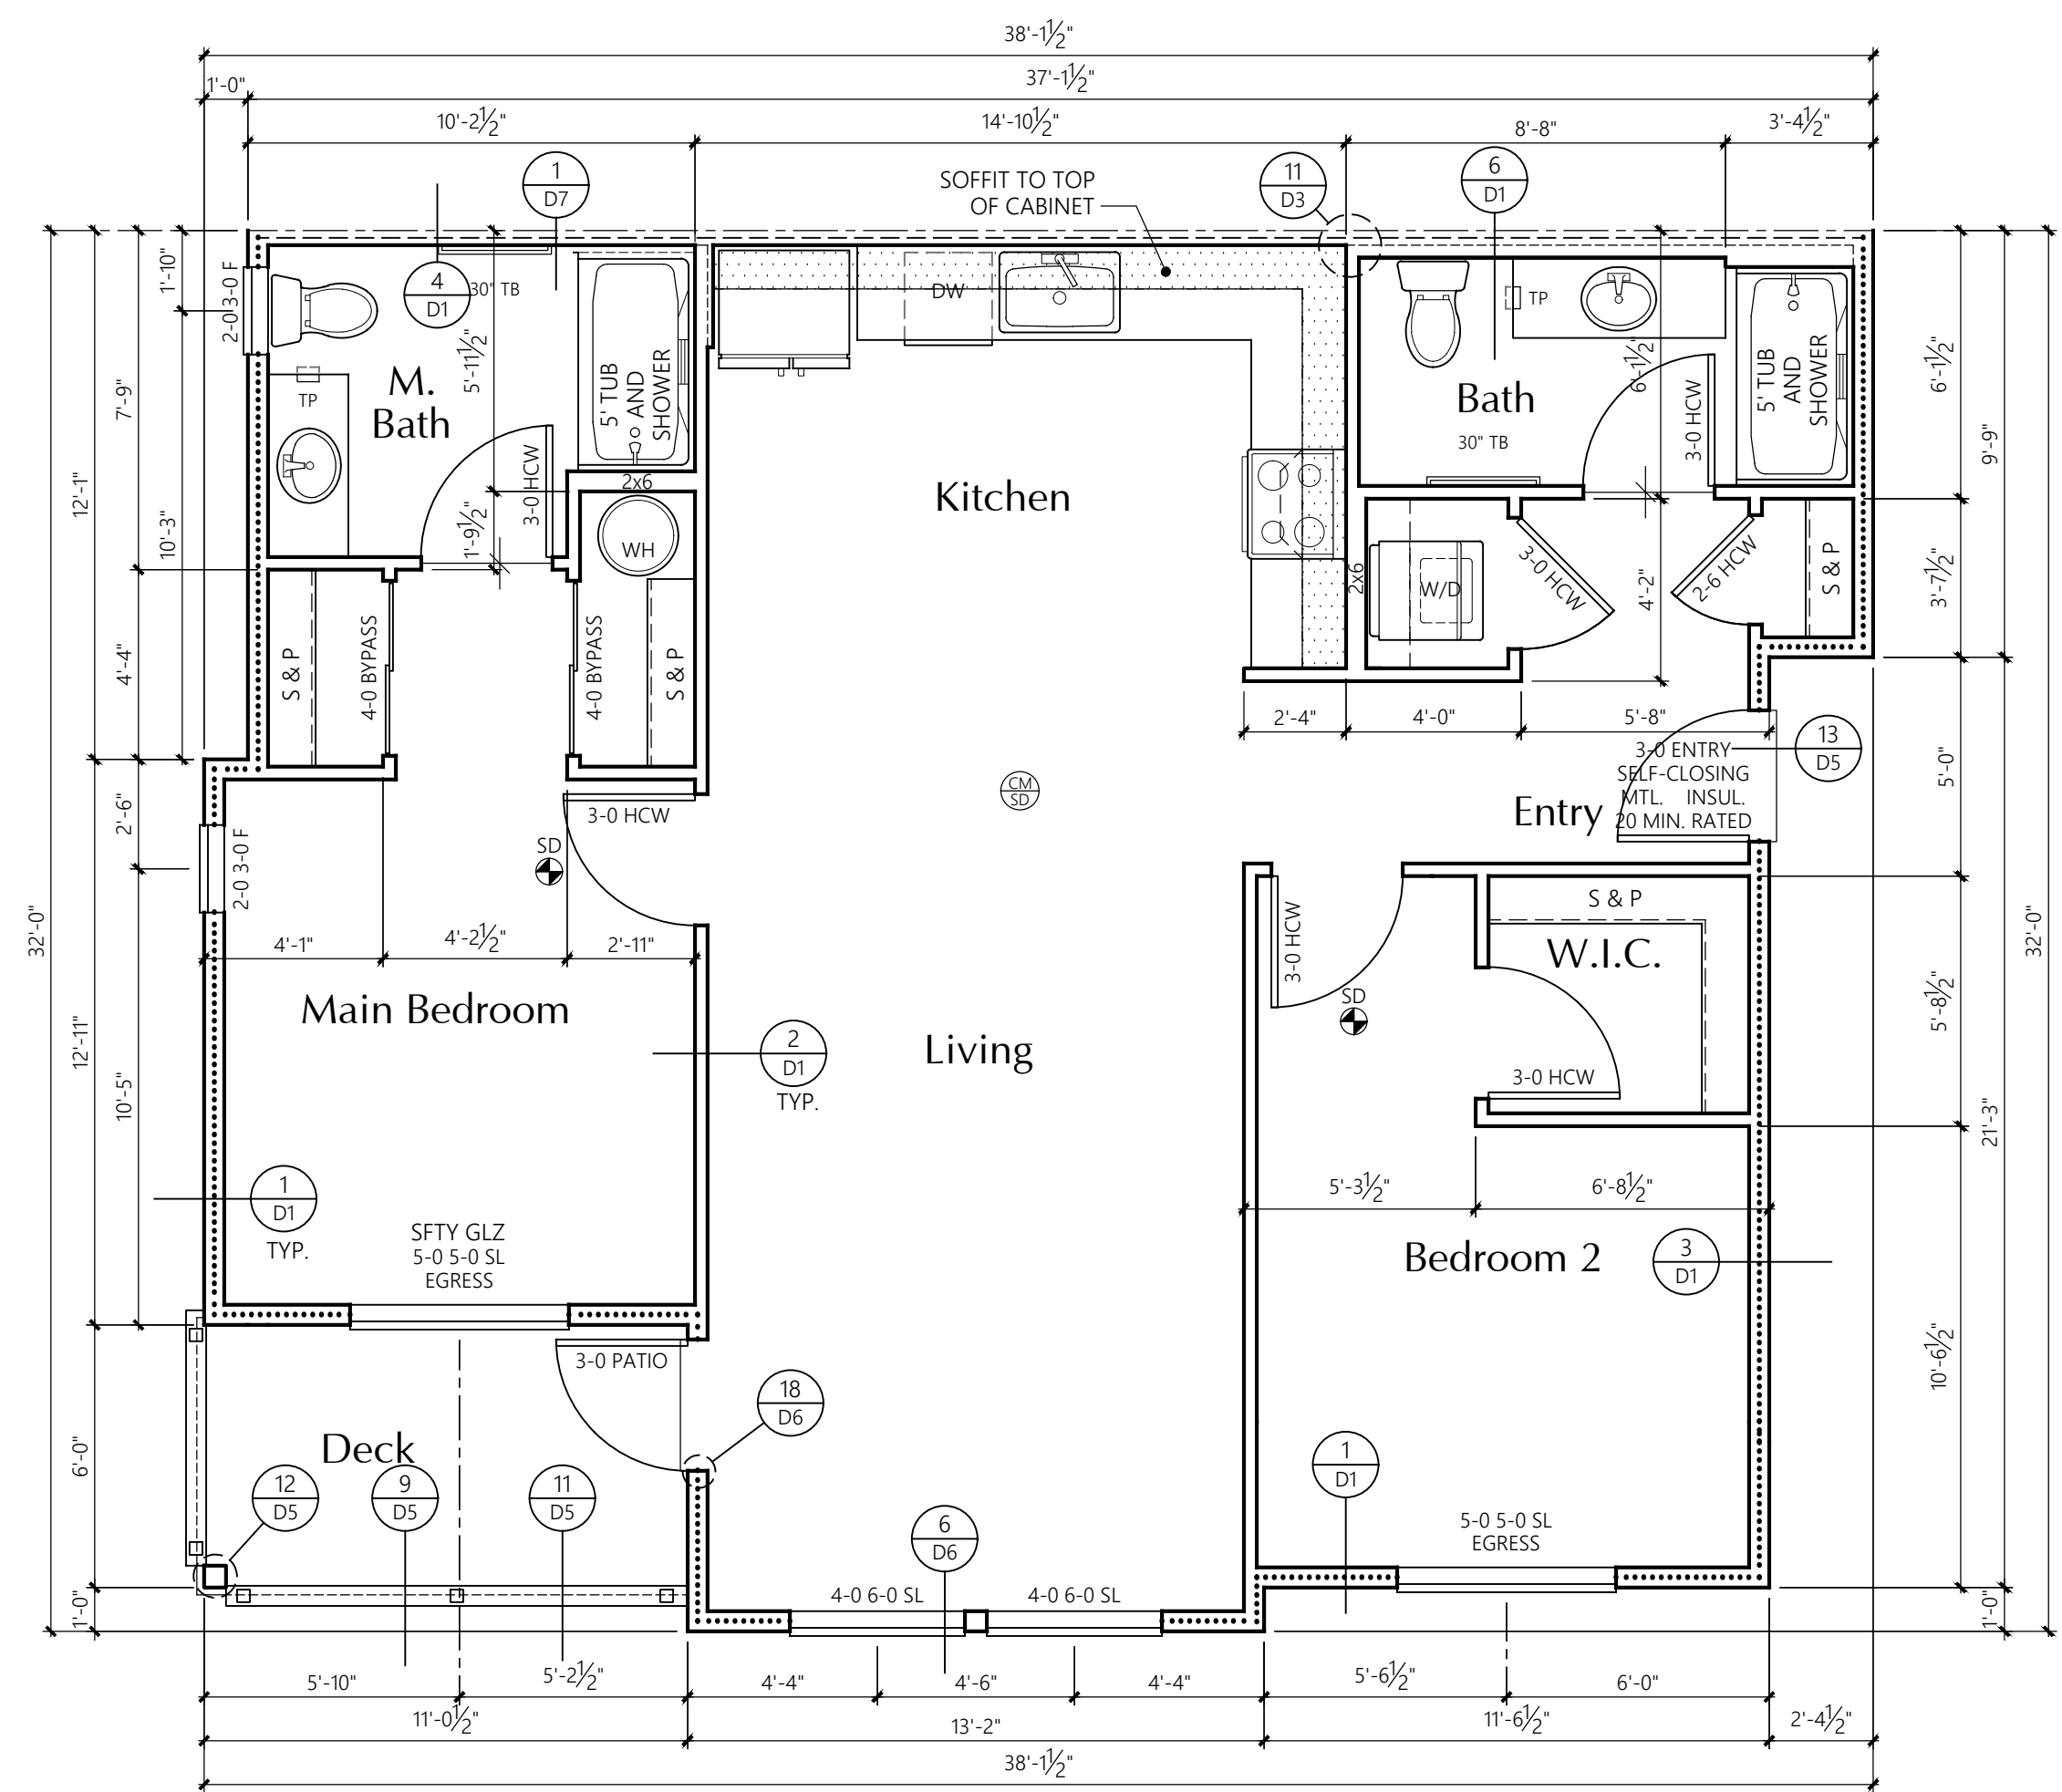

2-BED UNIT

1/4" = 1'-0"

NON-ACCESSIBLE 2nd & 3rd LEVEL FLOOR PLAN

AREA SUMMARY		
	Heated SF	Patio/Deck SF
Total SF	1019	66

UNIT PLAN NOTES

- FRAMING: 2x6'S AT EXTERIOR WALLS
2x4'S AT INTERIOR WALLS
UNLESS NOTED OTHERWISE.
- R-21 BATT INSULATION U.N.O.
- R-13 BATT INSULATION
3/8" ACOUSTICAL INSULATION ONE
SIDE OF PARTYWALL, U.N.O.
- [Pattern] LOCATION OF SOFFIT FOR VENT
RUNS. SOFFIT HEIGHT +8'-0" A.F.F.
U.N.O. ON PLANS; SEE DETAIL 1/D7
- [SD] SMOKE DETECTOR
- [SM] CARBON MONOXIDE/SMOKE DETECTOR

PROVIDE WATER RESISTANT GYPSUM WALLBOARD
BEHIND TUB AND SHOWER ENCLOSURE MATERIALS TO A
HEIGHT OF 70" MINIMUM ABOVE THE DRAIN INLET.

NO PLUMBING SHALL BE LOCATED IN THE 1" AIR SPACE OF FIRE
PARTITIONS OR FIRE WALLS.

ALL BEDROOM AND BATHROOM DOORS SHALL BE UNDERCUT
A MINIMUM OF 1/2" ABOVE THE ADJACENT FLOOR COVERING.

THE FRONT DOOR SHALL BE OPENABLE FROM THE INSIDE
WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE OR
EFFORT. IT MAY BE PROVIDED WITH A NIGHT LATCH, DEAD
BOLT OR SECURITY CHAIN, PROVIDED SUCH DEVICES ARE
OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR
TOOL, AND MOUNTED NOT TO EXCEED 48" ABOVE THE
FINISHED FLOOR.

GYPSUM WALLBOARD SCHEDULE
EXCEPT WHERE NOTED OTHERWISE, 5/8" TYPE 'X' GYPSUM
WALLBOARD SHALL BE USED THROUGHOUT;
ON INTERIOR NON-RATED WALLS, EXTERIOR WALLS,
CORRIDOR WALLS, AND 1-HOUR AND 2-HOUR FIRE-RATED
WALLS.

STANDARD PLATE
HEIGHT: 9'-1"

SEE ELEVATION SHEETS FOR
FLOOR TO FLOOR HEIGHTS

WINDOW HDR IS 8'-0"

UNLESS NOTED OTHERWISE

SEE SHEET U8 FOR INTERIOR ELEVATIONS
AND ACCESSIBILITY REQUIREMENTS.

CONCEALED SPACES SHALL BE FIRESTOPPED IN BOTH
DIRECTIONS AT 10'-0" ON CENTER AND AT FLOORS. TYPICAL.

ALL ESCAPE OR RESCUE WINDOWS FROM SLEEPING ROOMS
SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE
FEET. THE MINIMUM CLEAR OPENING HEIGHT DIMENSION
SHALL BE 24". MINIMUM CLEAR OPENING WIDTH DIMENSION
SHALL BE 20". EMERGENCY ESCAPE AND RESCUE OPENINGS
SHALL HAVE THE BOTTOM OF CLEAR OPENING NOT GREATER
THAN 44 INCHES MEASURED FROM THE FLOOR.

WHERE THE OPENING OF THE SILL PORTION OF AN OPERABLE
WINDOW IS LOCATED MORE THAN 72 INCHES ABOVE THE
FINISHED GRADE OR OTHER SURFACE BELOW, THE LOWEST
PART OF THE CLEAR OPENING OF THE WINDOW SHALL BE AT
A HEIGHT NOT LESS THAN 36 INCHES ABOVE THE FINISHED
FLOOR SURFACE OF THE ROOM IN WHICH THE WINDOW IS
LOCATED. OPERABLE SECTIONS OF WINDOWS SHALL NOT
PERMIT OPENINGS THAT ALLOW PASSAGE OF A 4-INCH
DIAMETER SPHERE WHERE SUCH OPENINGS ARE LOCATED
WITHIN 36 INCHES OF THE FINISHED FLOOR.

ALL GLAZING SHALL CONFORM TO THE 2018 IRC,
CHAPTER 24, SEC. 2406, SAFETY GLAZING. GLAZING IN ALL
DOORS SHALL BE SAFETY TYPE AND ALL GLAZING WITHIN A
24" ARC OF EITHER VERTICAL EDGE SHALL BE SAFETY TYPE.

PROVIDE 3/8" TYPE 'X' (MIN.) GYPSUM SHEATHING ON WALLS
BEHIND TUB/SHOWERS TO SATISFY FIRE REQUIREMENTS AT
PARTYWALL CONDITION. PROVIDE 1/2" PLYWOOD UNDER TUB
IN PLACE OF THE GYPCRETE, SEE DETAIL 14/D1

DOOR KEY:

- TYPE:
SW = SWING
BF = BIFOLD
BP = BYPASS
- CONSTRUCTION:
HCW = HOLLOW CORE WD.
SCW = SOLID CORE WD.
MTL = METAL
HM = HOLLOW METAL

WINDOW KEY:

- TYPE:
FIX = FIXED/PICTURE
SL = SLIDER
SH = SINGLE HUNG
SGD = SLIDING GLASS DOOR

INSULATION

FOUNDATION PERIMETER - R-10 RIGID INSULATION
TO A DEPTH OF 24" OR TO TOP OF FOOTING AT
HEATED PERIMETER

EXTERIOR WALLS: FIBERGLASS BATTS OR BLANKETS
2x6 WALLS - R21

FLOORS OVER UNHEATED SPACES - R30


ATTICS AND ROOF ASSEMBLIES - R-49
FULL HEIGHT OF UNCOMPRESSED INSULATION
EXTENDS OVER THE WALL TOP PLATE AT
THE EAVES.

EXTERIOR DOORS: MAIN ENTRY U=0.20
ALL OTHERS U=0.40


WINDOWS: MILGARD VINYL
TYPE (VINYL) MODEL U-VALUE
SLIDING 6110 ARGON/LoE 0.24 or BETTER
FIXED 6310 ARGON/LoE 0.24 or BETTER
SINGLE HUNG 6210 ARGON/LoE 0.24 or BETTER
DBL SLIDER 8125 ARGON/LoE 0.24 or BETTER
SGD 6610 ARGON/LoE 0.24 or BETTER

NOTE: ALL CONCEALED OR EXPOSED INSULATION
SHALL HAVE A FLAME SPREAD INDEX OF NOT
MORE THAN 25 AND A SMOKE-DEVELOPED
INDEX OF NOT MORE THAN 450




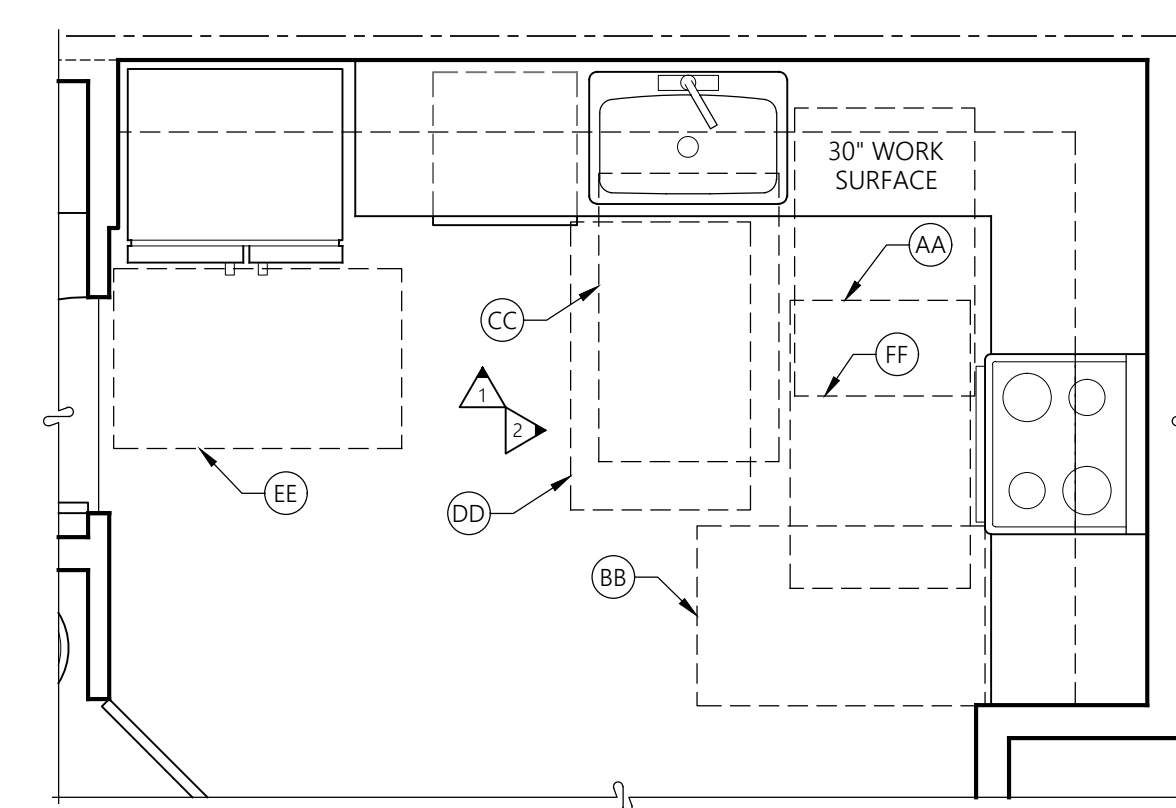


1-BED-UNIT TYPE 'A'
KITCHEN PLAN
3/8" = 1'-0"

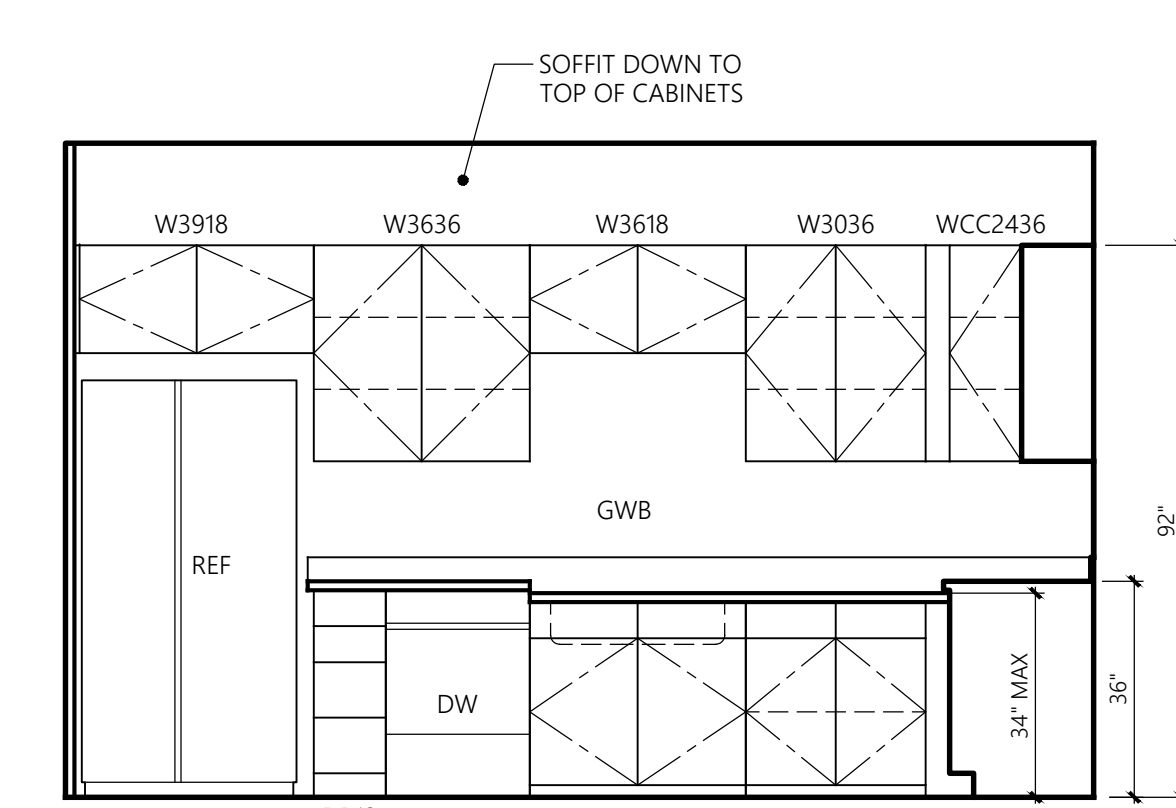


① KITCHEN

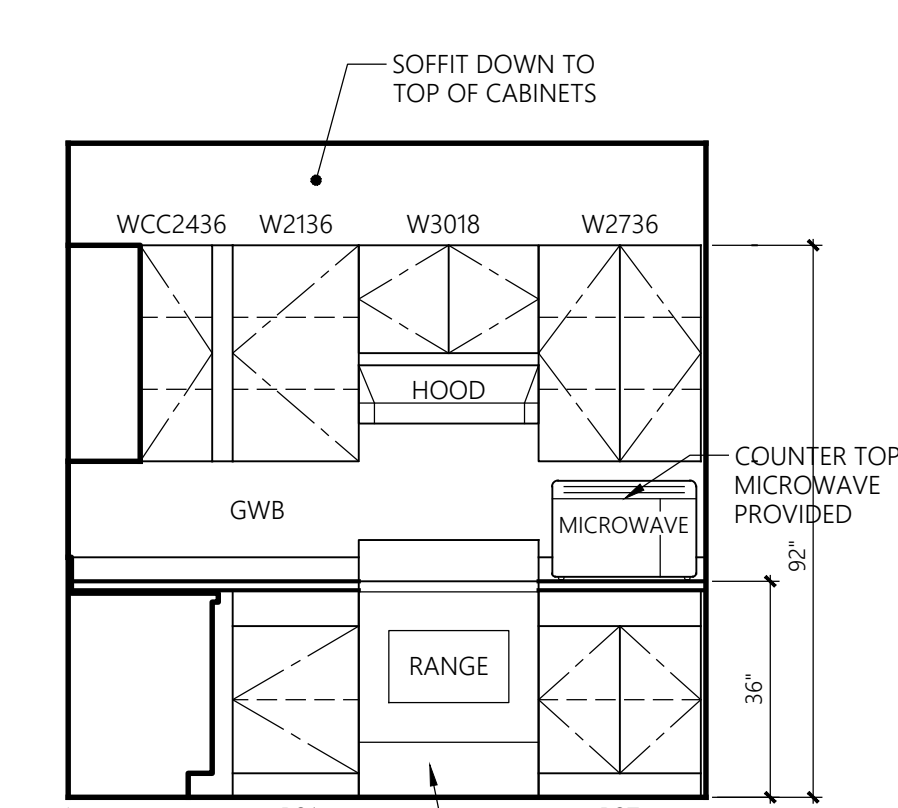


② KITCHEN

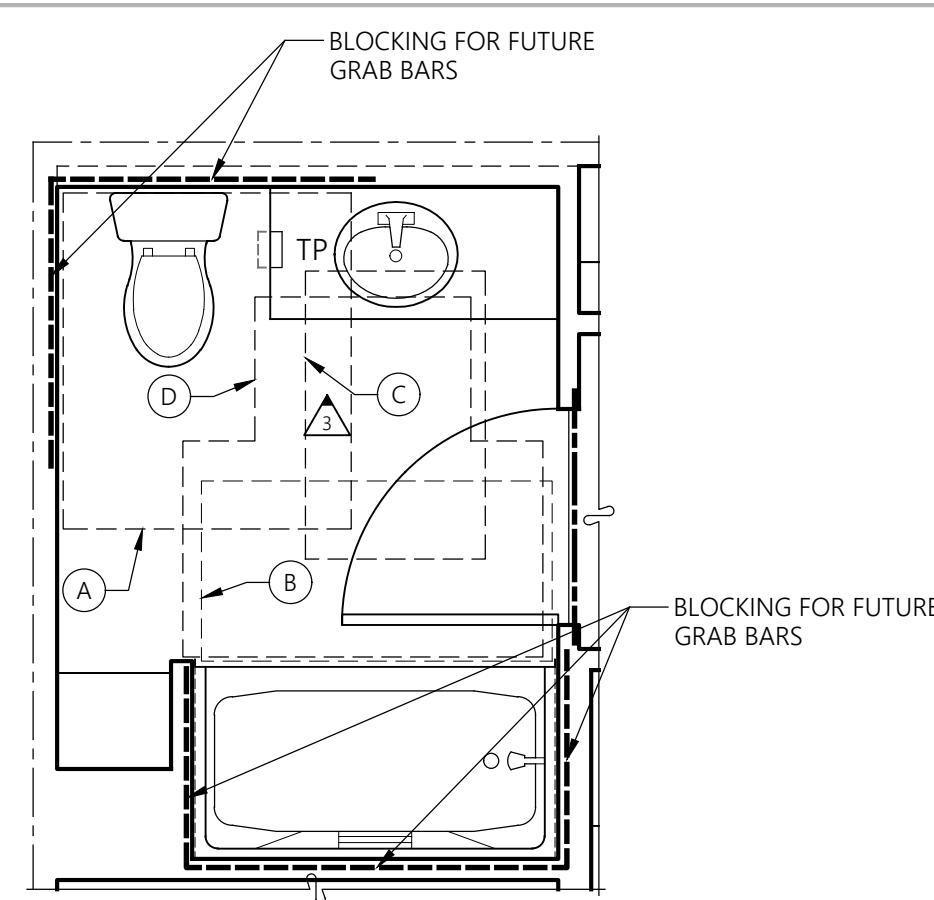


1-BED-UNIT TYPE 'A'
BATHROOM PLAN
3/8" = 1'-0"

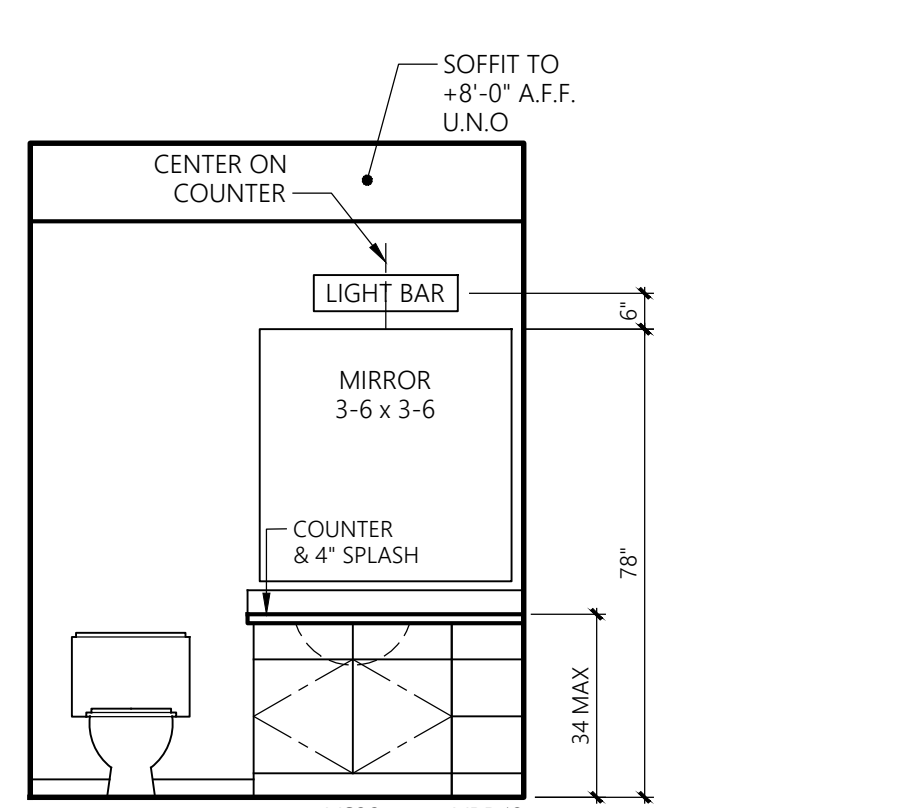


③ BATH

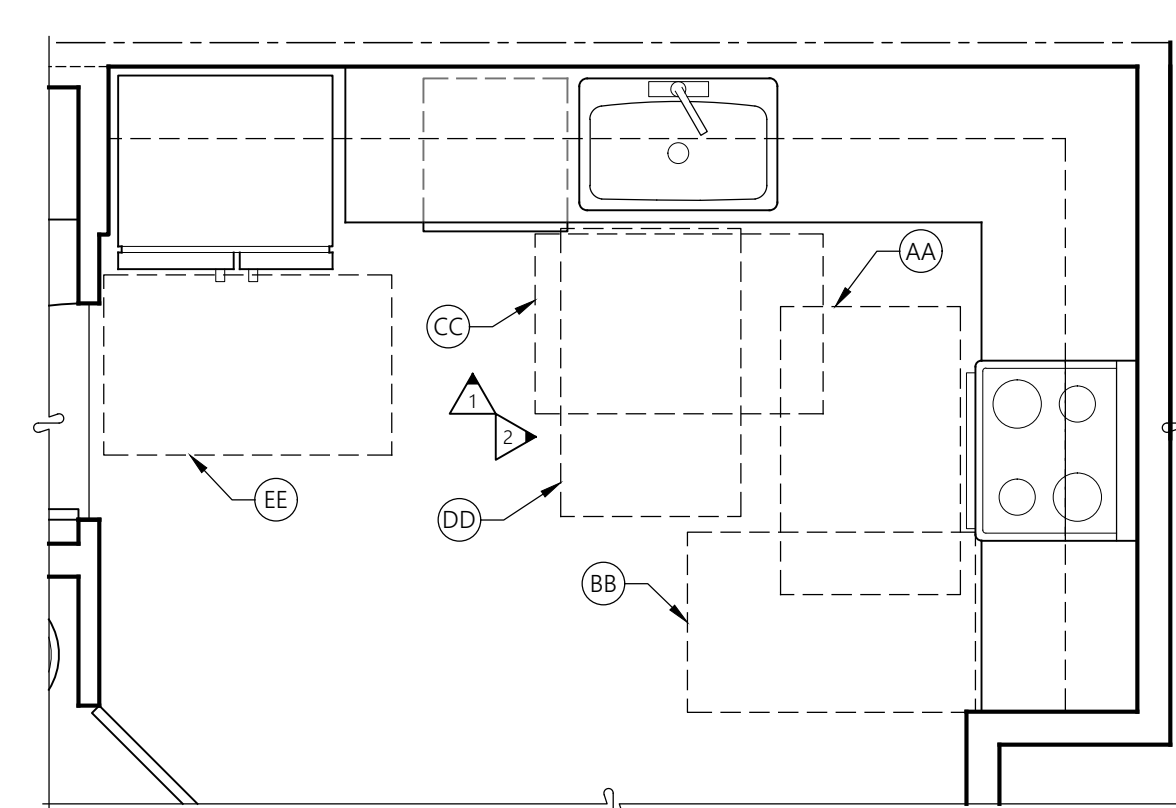


1-BED-UNIT TYPE 'B'
KITCHEN PLAN
3/8" = 1'-0"

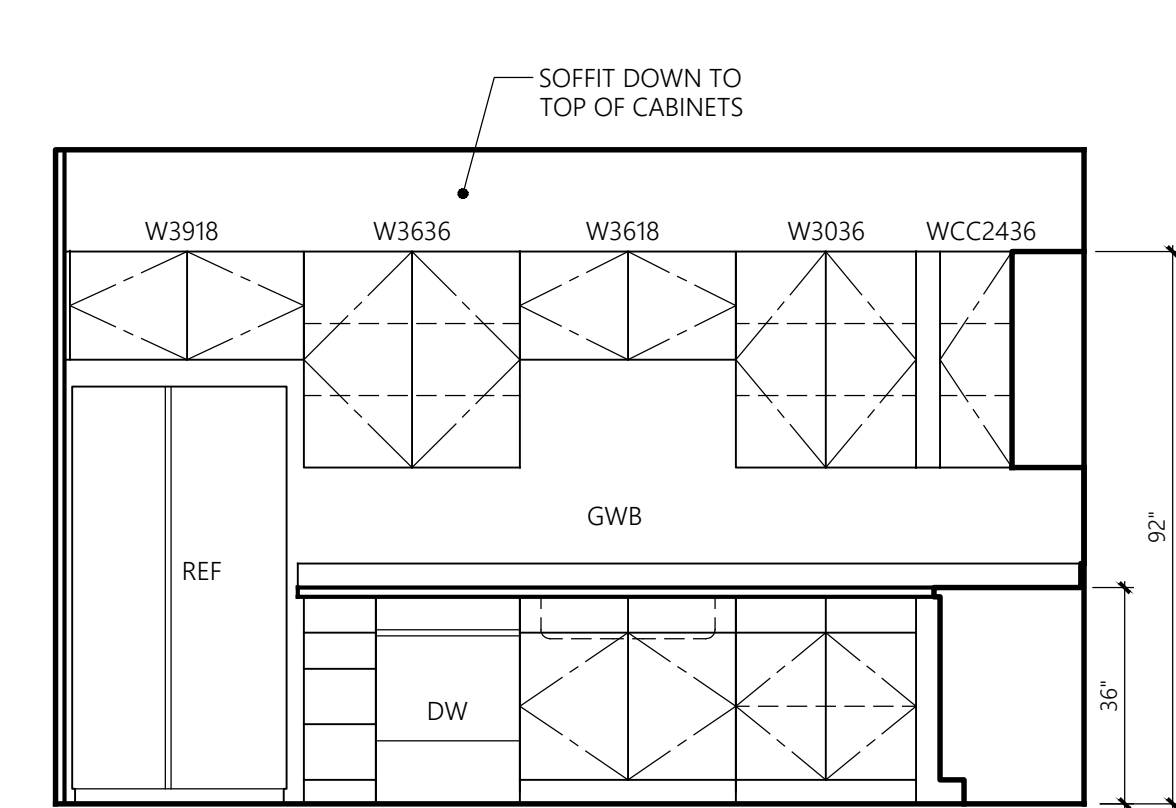


① KITCHEN

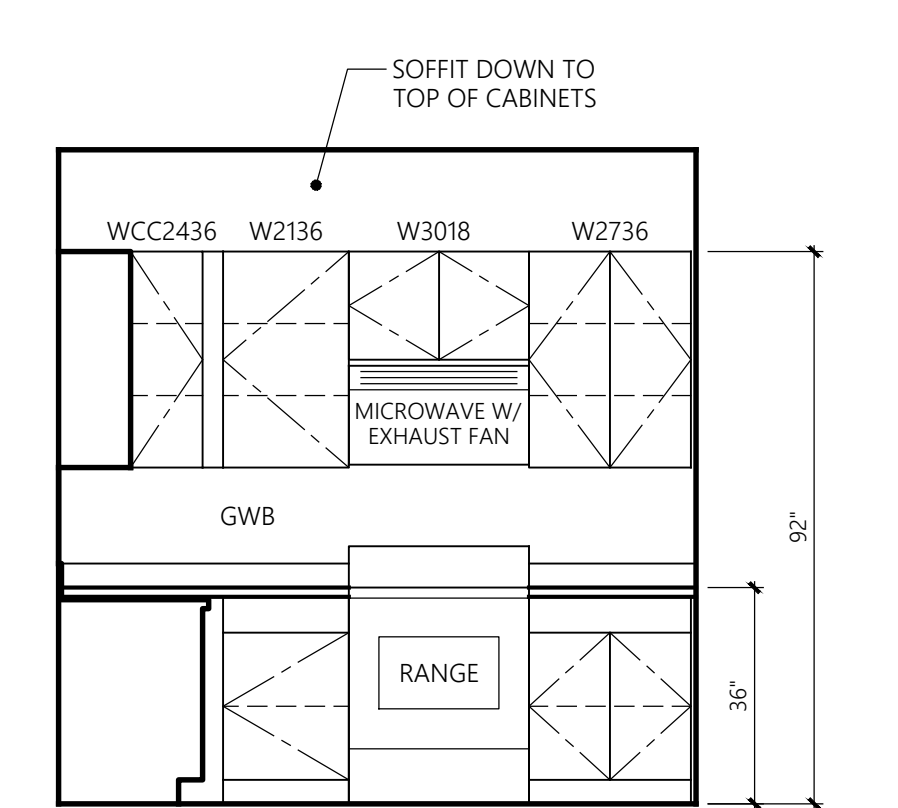


② KITCHEN

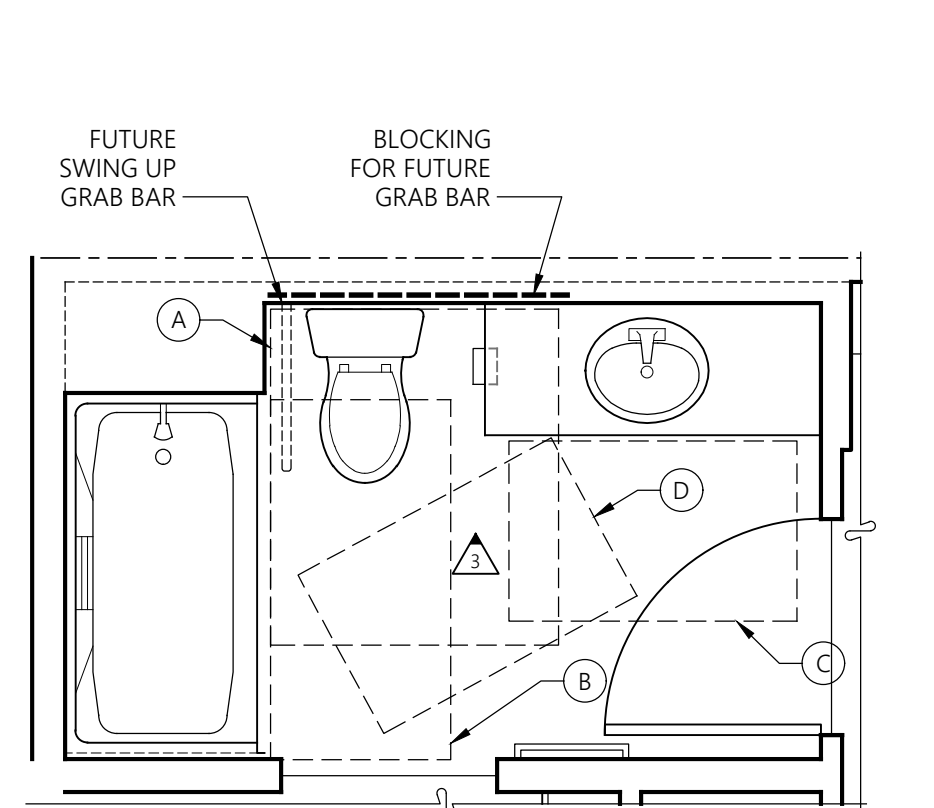


1-BED-UNIT TYPE 'B'
BATHROOM PLAN
3/8" = 1'-0"

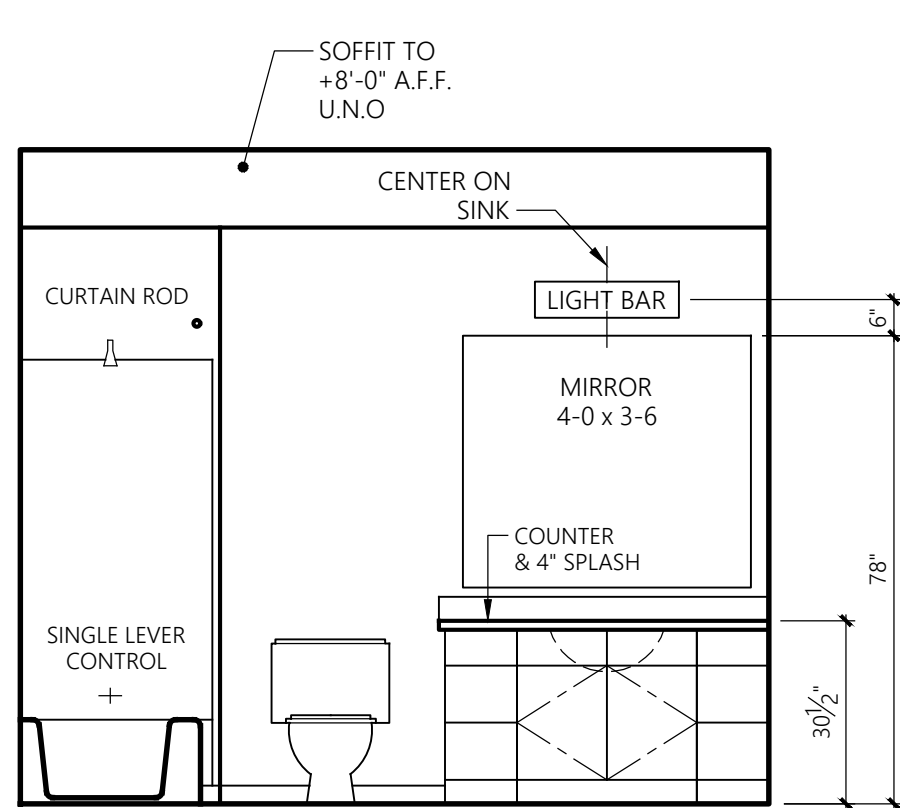


③ BATH

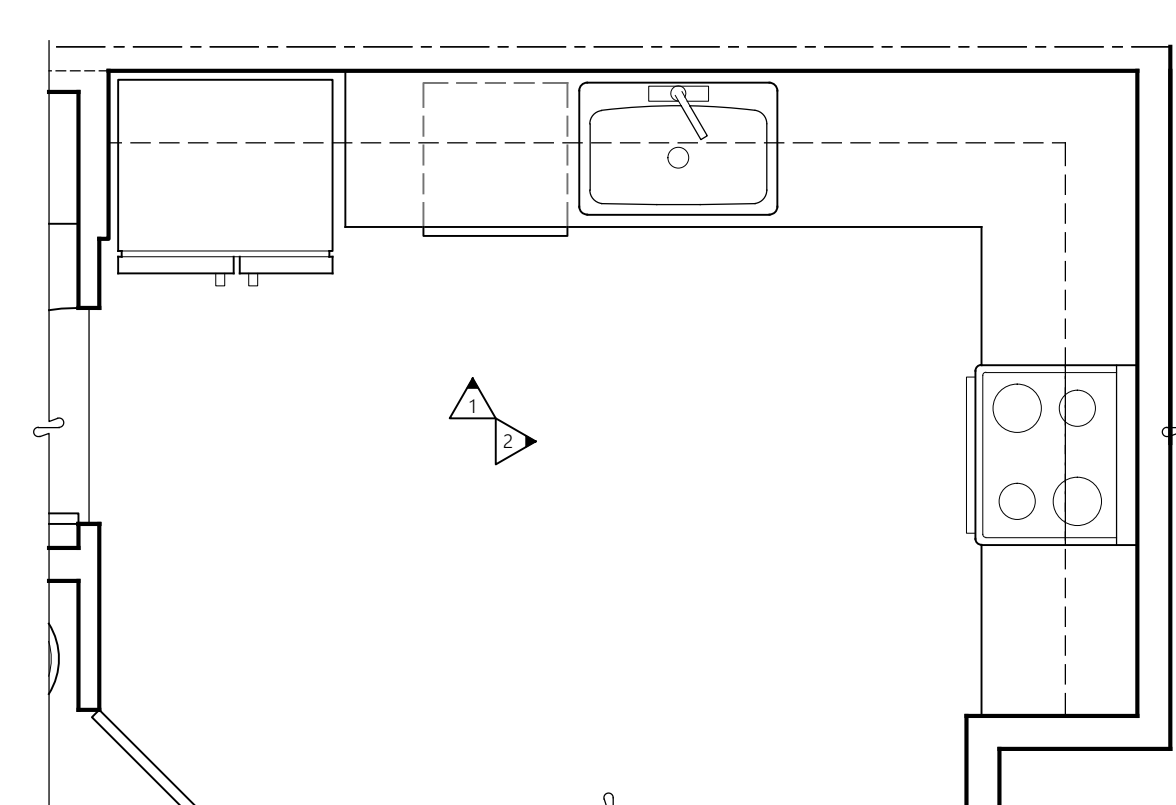


1-BED-UNIT NON-ACCESSIBLE
KITCHEN PLAN
3/8" = 1'-0"

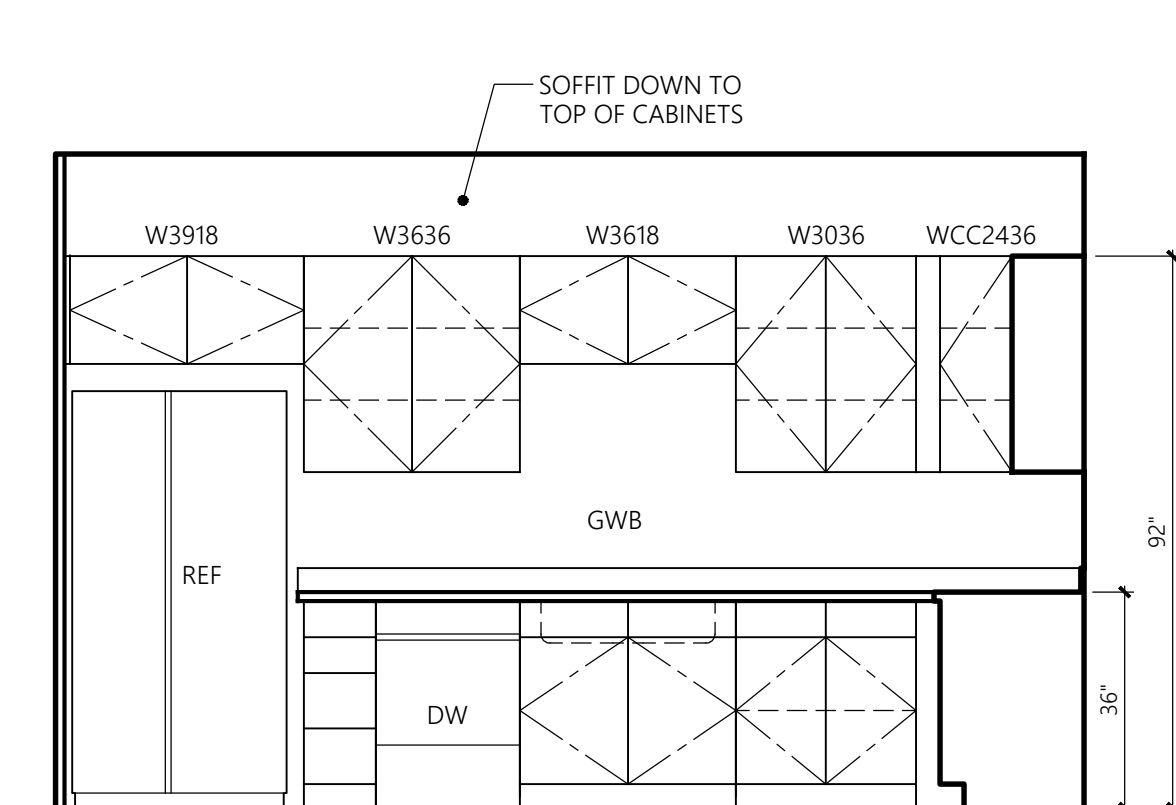


① KITCHEN

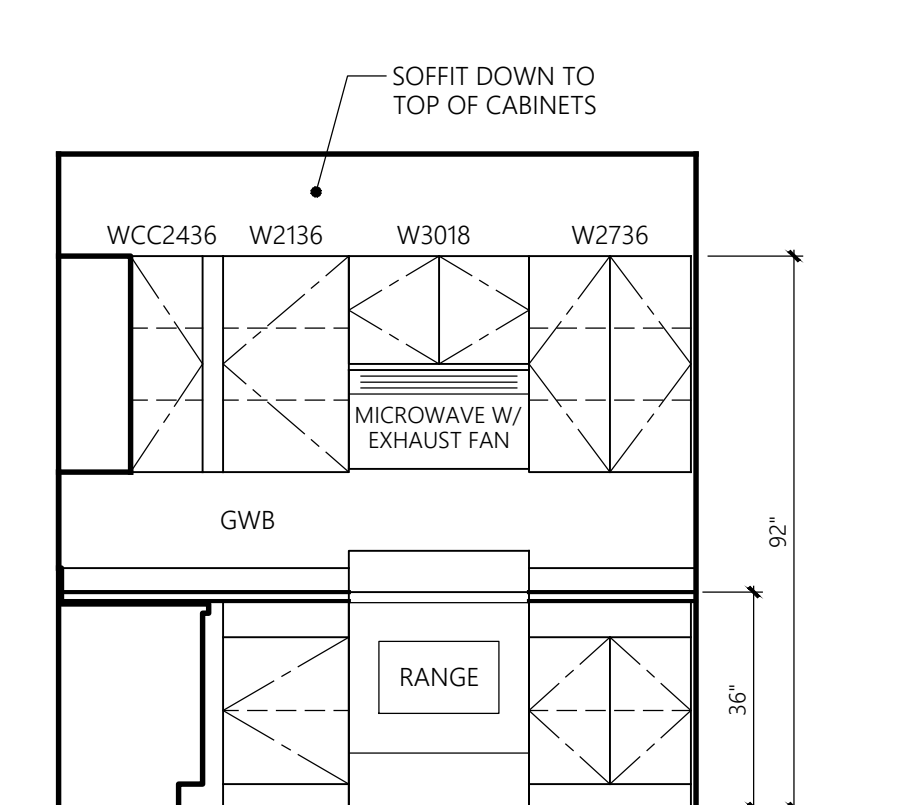

② KITCHEN

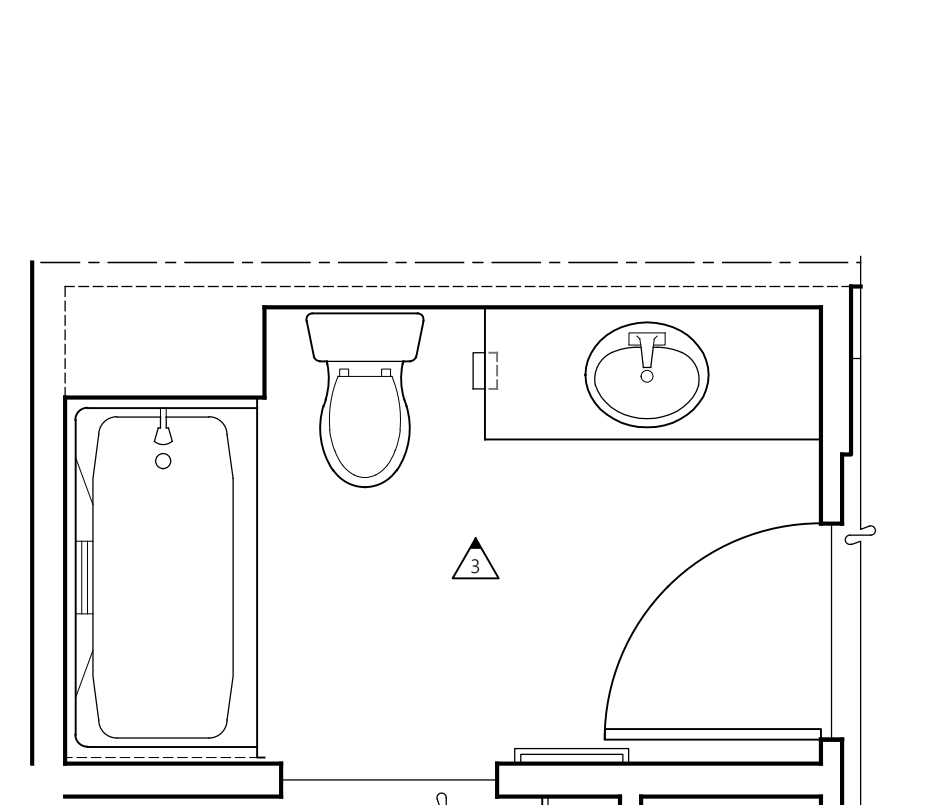

1-BED-UNIT NON-ACCESSIBLE
BATHROOM PLAN
3/8" = 1'-0"

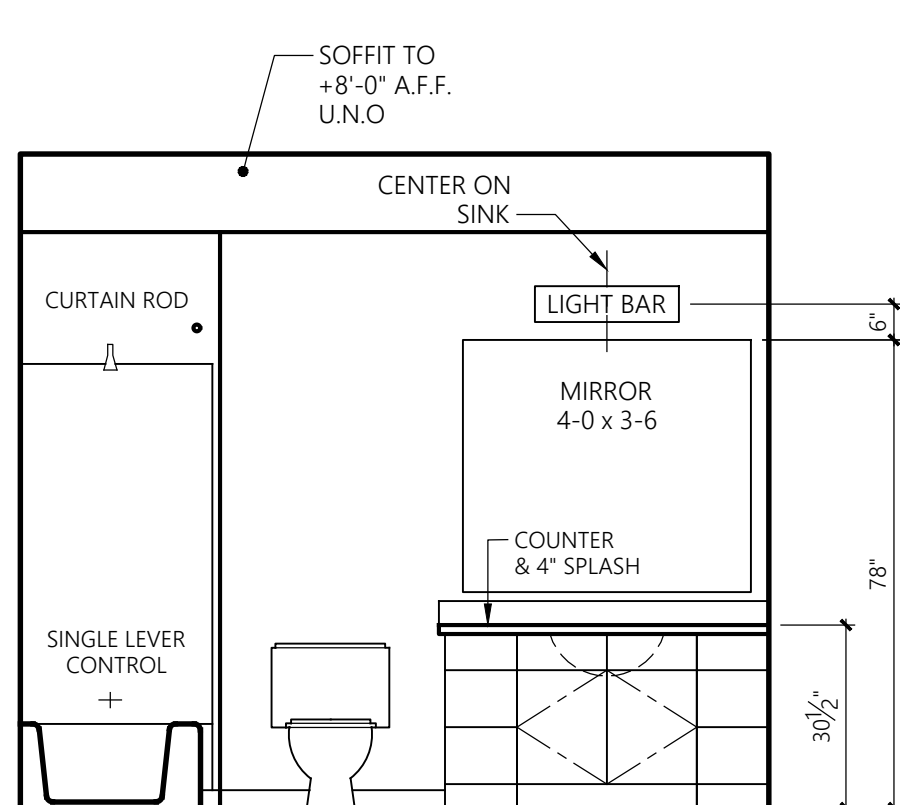

③ BATH


*SEE SHEET U9 FOR ACCESSIBILITY STANDARDS

CLEAR FLOOR SPACE LEGEND
TYPE A UNIT


- (A) 60x66 CLEAR FLOOR SPACE AT TOILET.
- (B) 30x60 CLEAR FLOOR SPACE AT TUB.
- (C) 30"x48" CLEAR FLOOR SPACE CENTERED ON SINK
- (D) 60" DIAMETER TURNING CIRCLE OR T-SHAPE TURNING SPACE
- (AA) 30x48 CLEAR FLOOR SPACE AT STOVE.
- (BB) 30x48 CLEAR FLOOR SPACE AT OVEN.
- (CC) 30x48 CLEAR FLOOR SPACE AT SINK.
- (DD) 30x48 CLEAR FLOOR SPACE AT DISHWASHER.
- (EE) 30x48 CLEAR FLOOR SPACE AT REFRIGERATOR.
- (FF) 30x48 CLEAR FLOOR SPACE AT WORK SURFACE.
- (GG) 30x48 CLEAR FLOOR SPACE AT WASHER/DRYER

CLEAR FLOOR SPACE LEGEND
TYPE B UNIT


- (A) 48x56 CLEAR FLOOR SPACE AT TOILET.
- (B) 30x48 CLEAR FLOOR SPACE AT TUB.
- (C) 30"x48" CLEAR FLOOR SPACE CENTERED ON SINK
- (D) 30"x48" CLEAR FLOOR SPACE BEYOND ARC OF DOOR.
- (AA) 30x48 CLEAR FLOOR SPACE AT STOVE.
- (BB) 30x48 CLEAR FLOOR SPACE AT OVEN.
- (CC) 30x48 CLEAR FLOOR SPACE AT SINK.
- (DD) 30x48 CLEAR FLOOR SPACE AT DISHWASHER.
- (EE) 30x48 CLEAR FLOOR SPACE AT REFRIGERATOR.
- (GG) 30x48 CLEAR FLOOR SPACE AT WASHER/DRYER

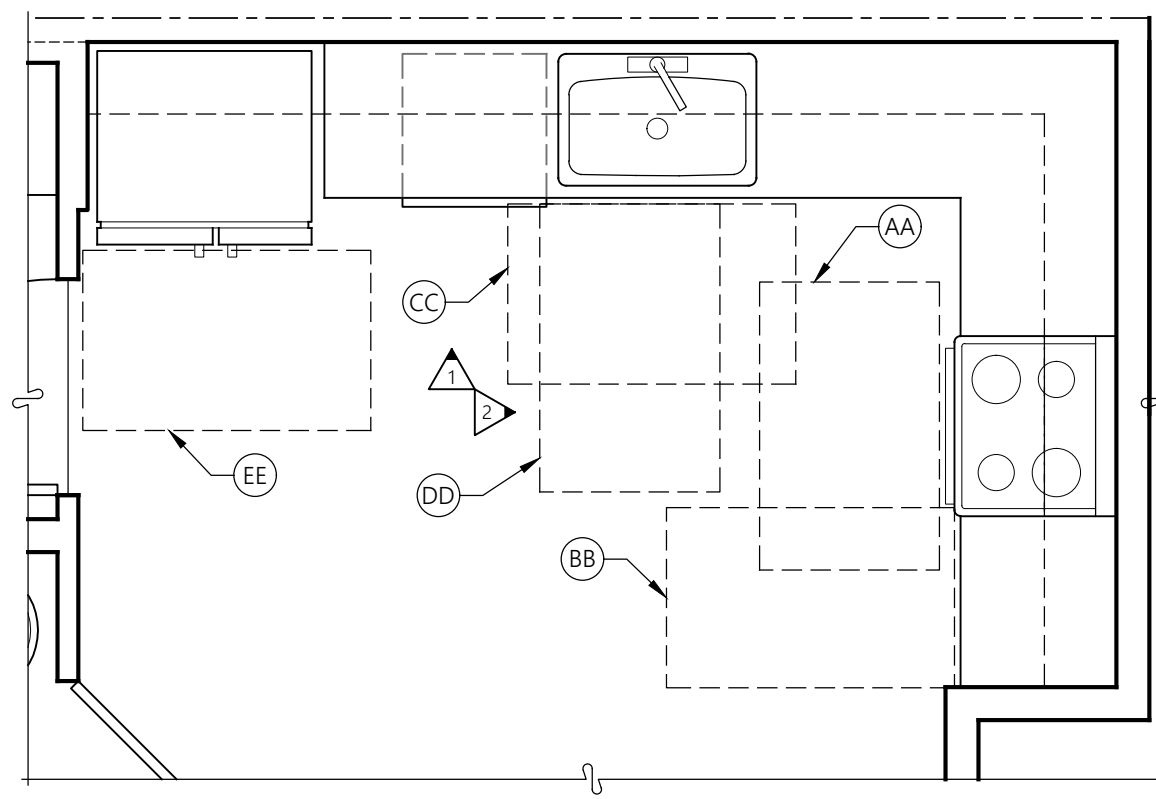


1-BED-END UNIT TYPE 'B'
KITCHEN PLAN
3/8" = 1'-0"

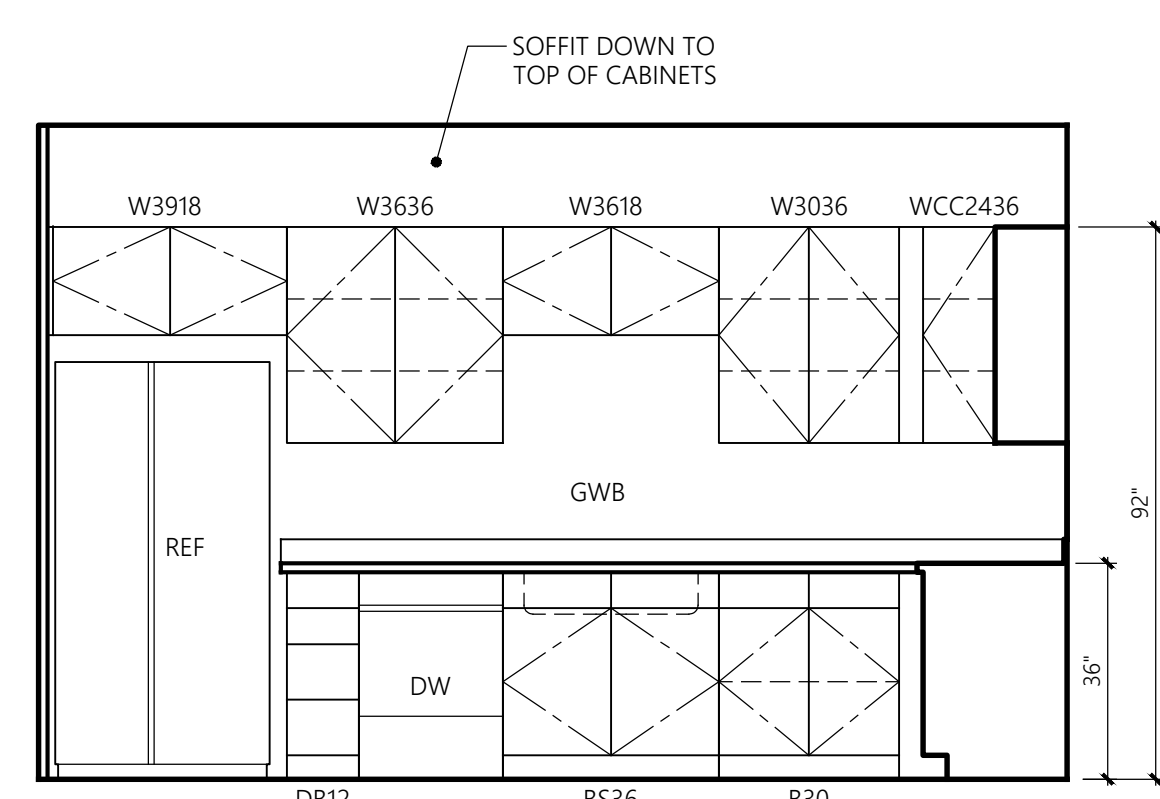


1 KITCHEN

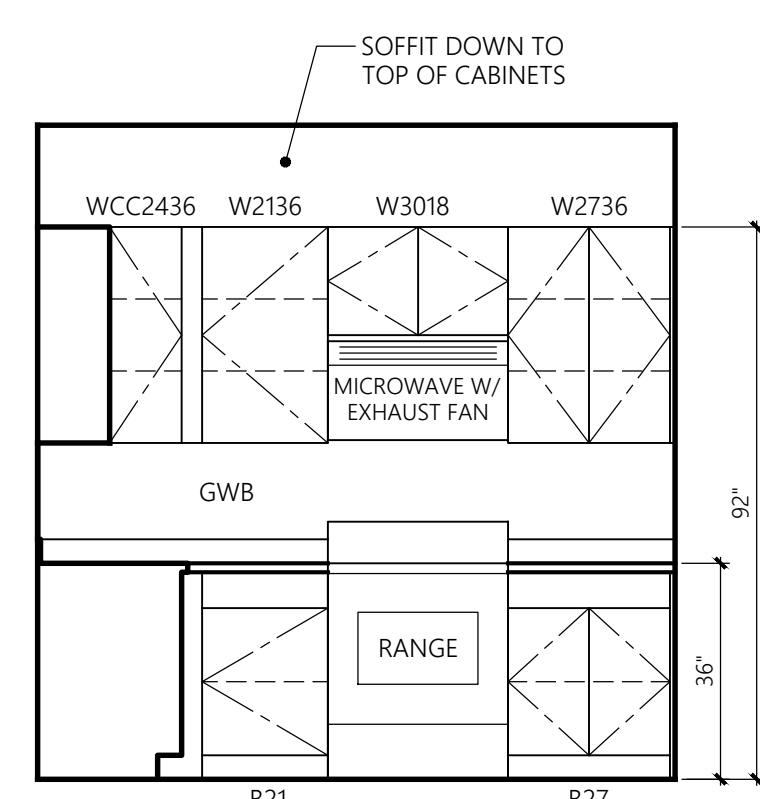


2 KITCHEN

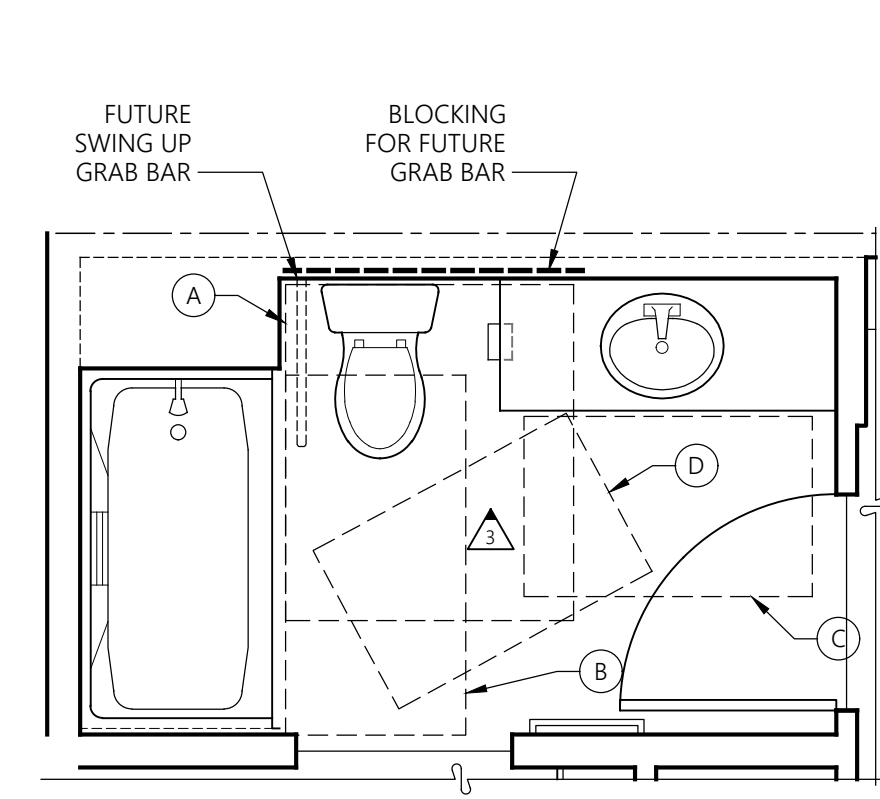


1-BED-END UNIT TYPE 'B'
BATHROOM PLAN
3/8" = 1'-0"

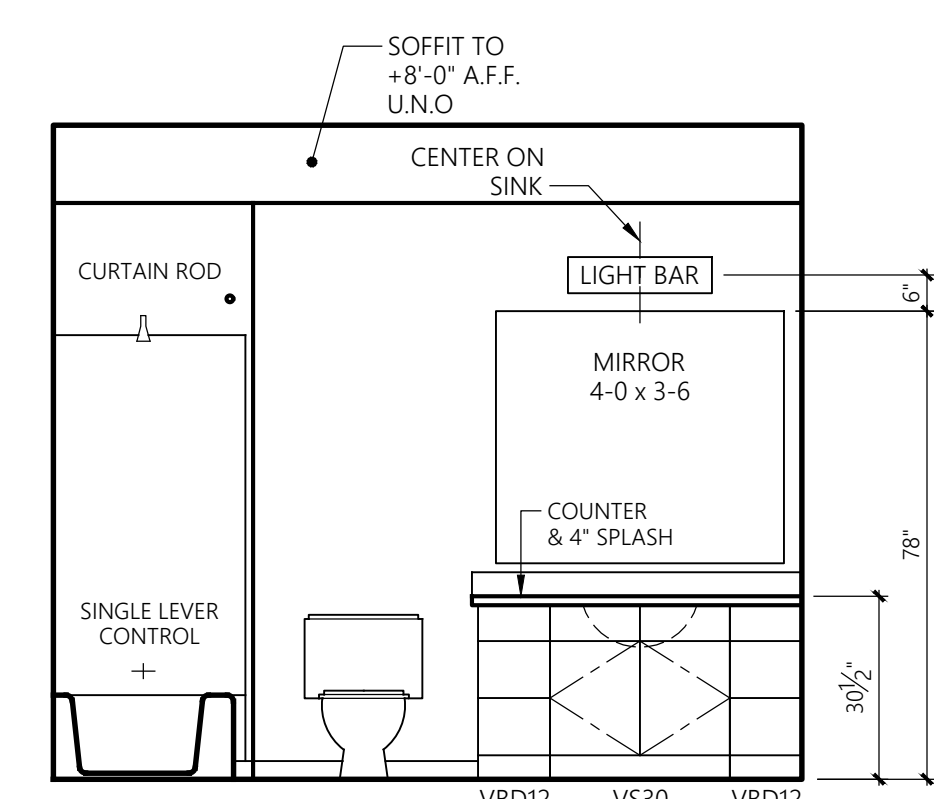


3 BATH

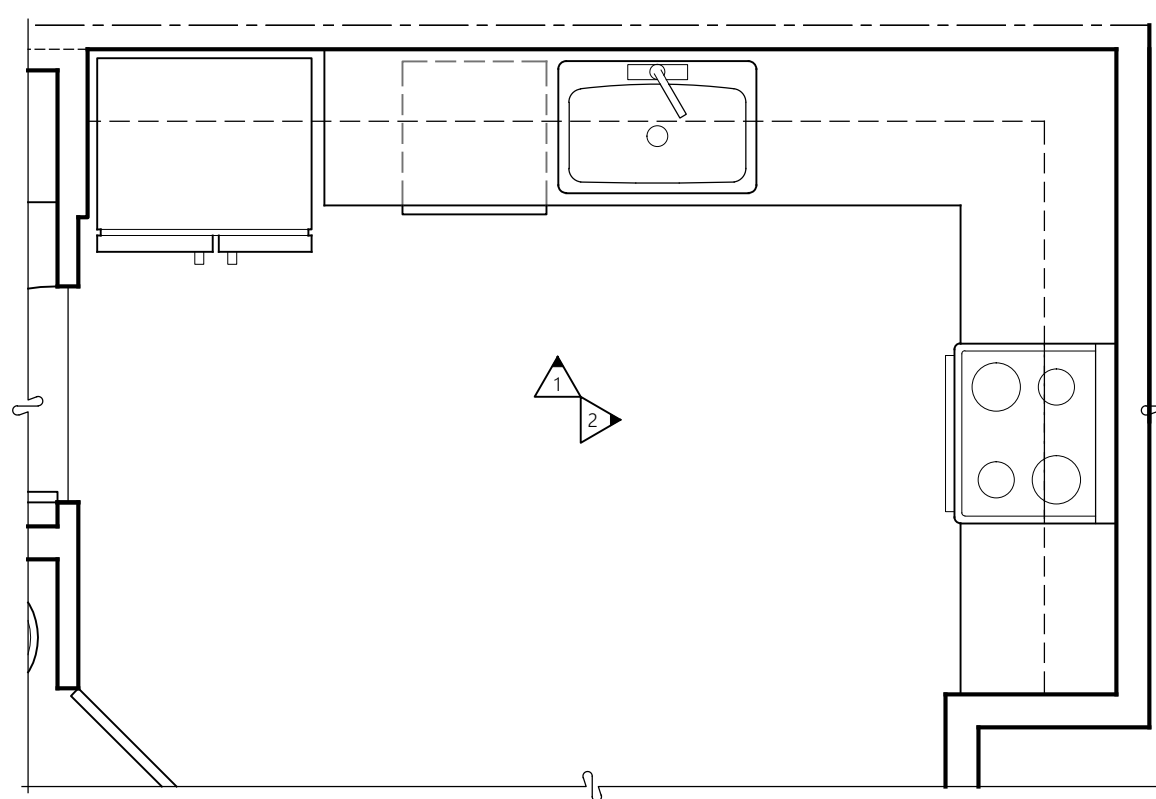


1-BED-END UNIT NON-ACCESSIBLE
KITCHEN PLAN
3/8" = 1'-0"

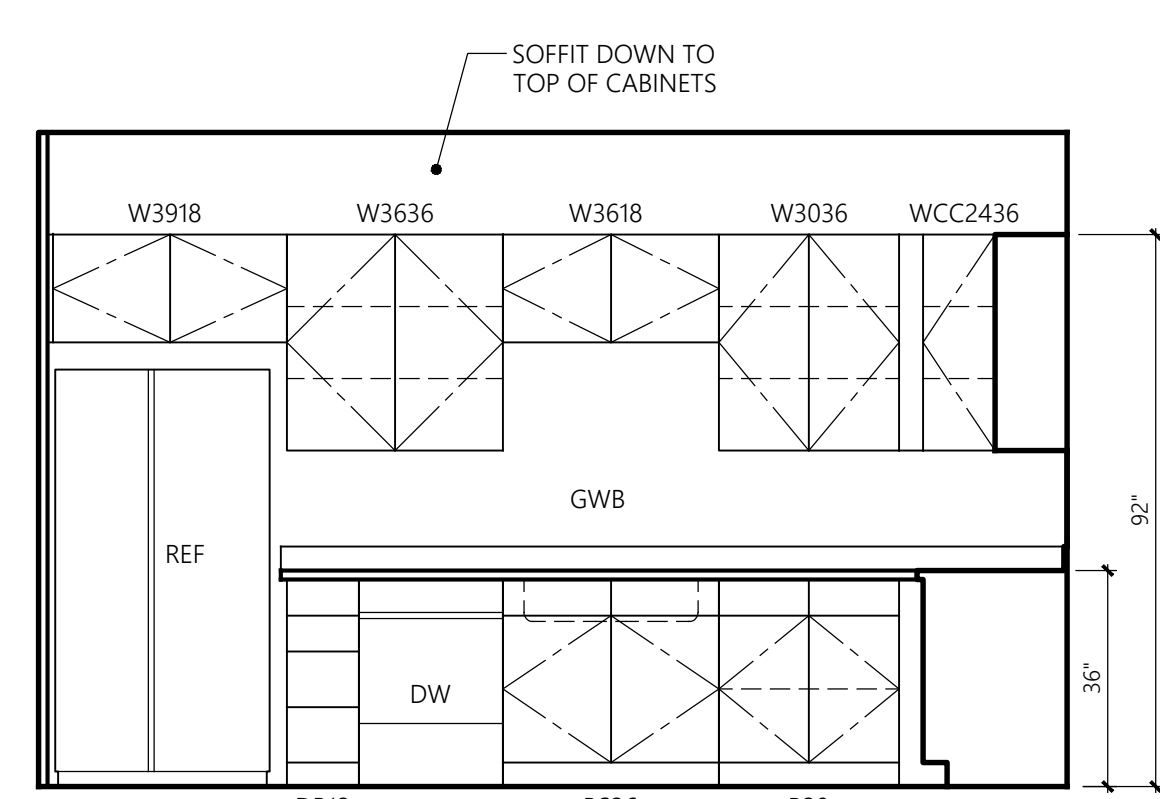


1 KITCHEN

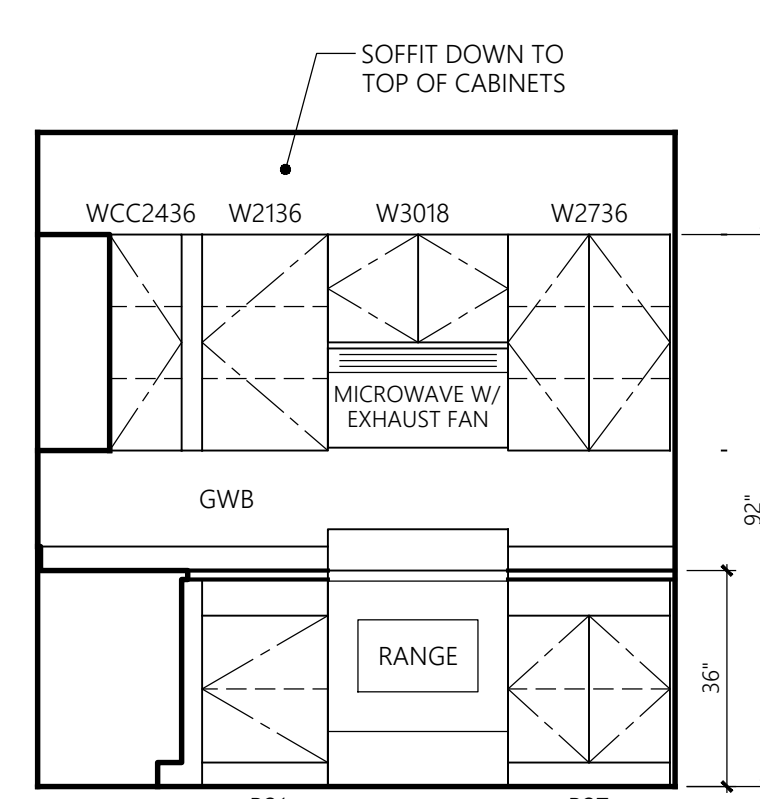

2 KITCHEN

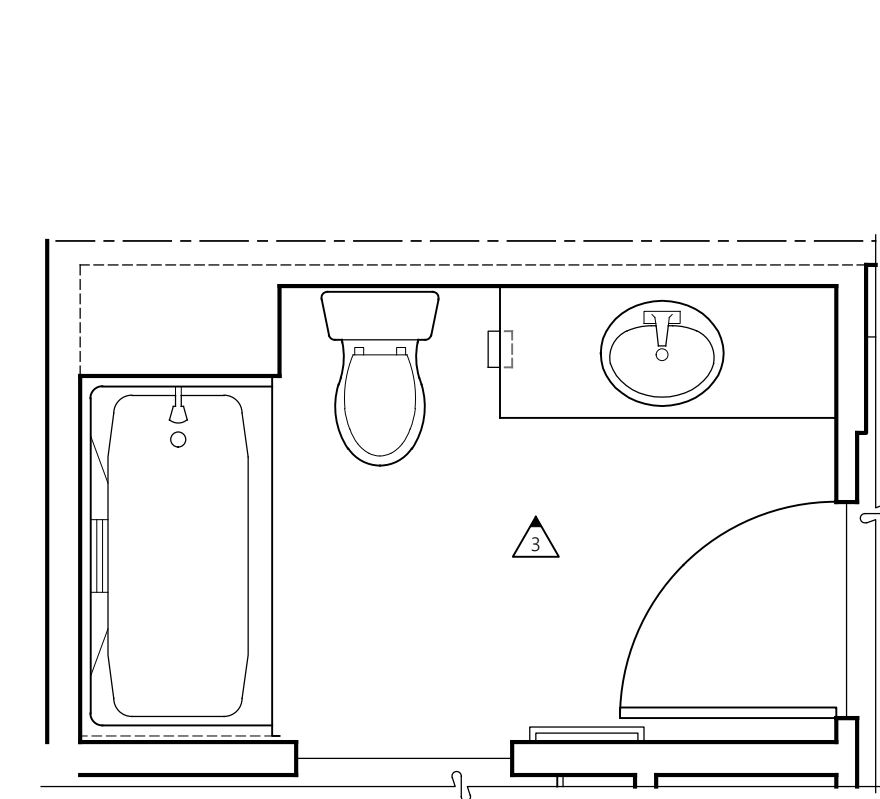

1-BED-END UNIT BATHROOM PLAN
3/8" = 1'-0"

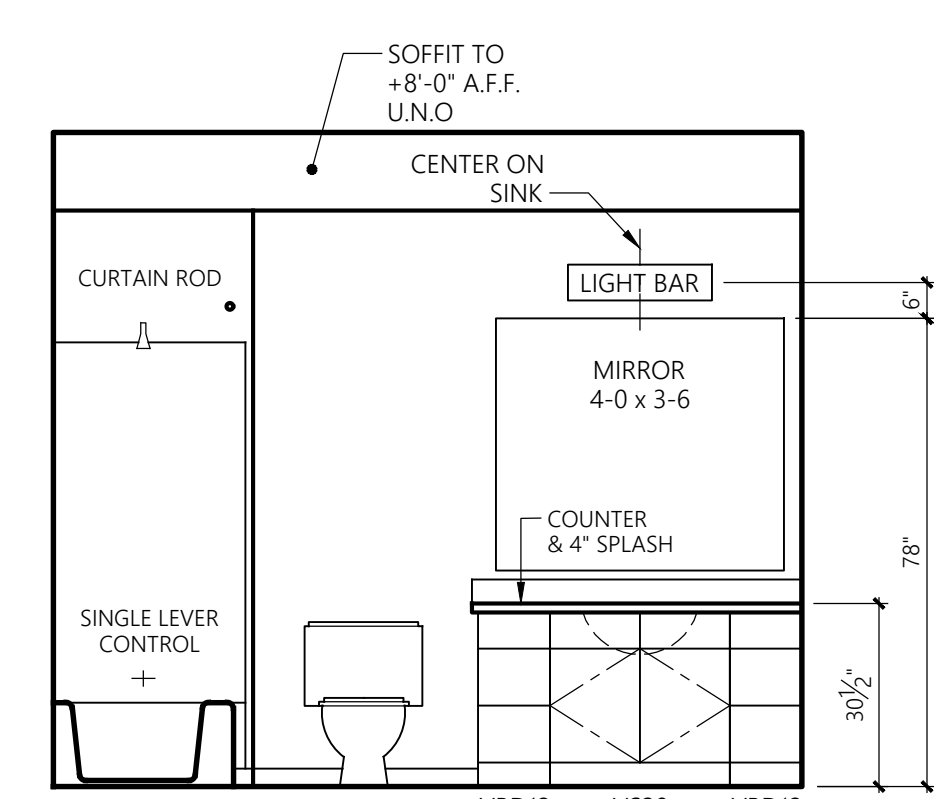

3 BATH

*SEE SHEET U9 FOR ACCESSIBILITY STANDARDS


CLEAR FLOOR SPACE LEGEND
TYPE A UNIT

- (A) 60x66 CLEAR FLOOR SPACE AT TOILET.
- (B) 30x60 CLEAR FLOOR SPACE AT TUB.
- (C) 30"x48" CLEAR FLOOR SPACE CENTERED ON SINK
- (D) 60" DIAMETER TURNING CIRCLE OR T-SHAPE TURNING SPACE
- (AA) 30x48 CLEAR FLOOR SPACE AT STOVE.
- (BB) 30x48 CLEAR FLOOR SPACE AT OVEN.
- (CC) 30x48 CLEAR FLOOR SPACE AT SINK.
- (DD) 30x48 CLEAR FLOOR SPACE AT DISHWASHER.
- (EE) 30x48 CLEAR FLOOR SPACE AT REFRIGERATOR.
- (FF) 30x48 CLEAR FLOOR SPACE AT WORK SURFACE.
- (GG) 30x48 CLEAR FLOOR SPACE AT WASHER/DRYER

CLEAR FLOOR SPACE LEGEND
TYPE B UNIT

- (A) 48x56 CLEAR FLOOR SPACE AT TOILET.
- (B) 30x48 CLEAR FLOOR SPACE AT TUB.
- (C) 30"x48" CLEAR FLOOR SPACE CENTERED ON SINK
- (D) 30"x48" CLEAR FLOOR SPACE BEYOND ARC OF DOOR.
- (AA) 30x48 CLEAR FLOOR SPACE AT STOVE.
- (BB) 30x48 CLEAR FLOOR SPACE AT OVEN.
- (CC) 30x48 CLEAR FLOOR SPACE AT SINK.
- (DD) 30x48 CLEAR FLOOR SPACE AT DISHWASHER.
- (EE) 30x48 CLEAR FLOOR SPACE AT REFRIGERATOR.
- (GG) 30x48 CLEAR FLOOR SPACE AT WASHER/DRYER


FF_V2309_VINTERIOR_ELEVATIONS.DWG

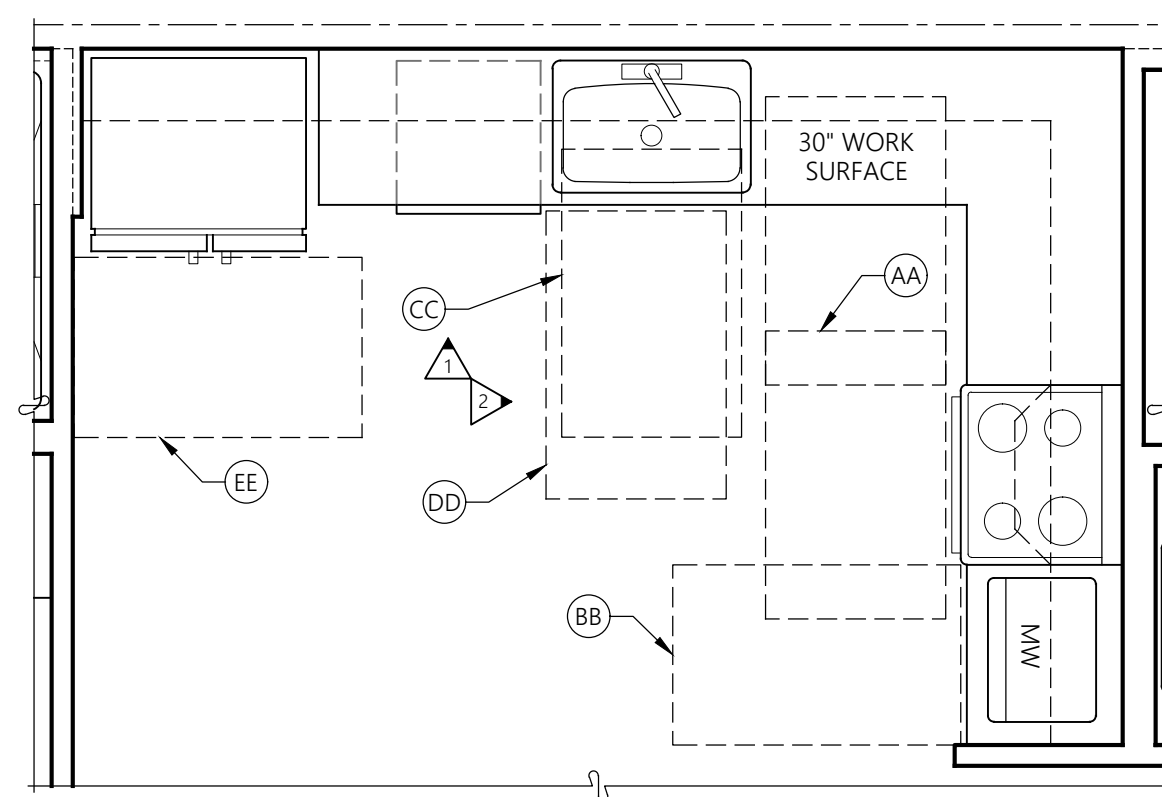


2-BED UNIT

3/8" = 1'-0"


TYPE 'A'
KITCHEN PLAN

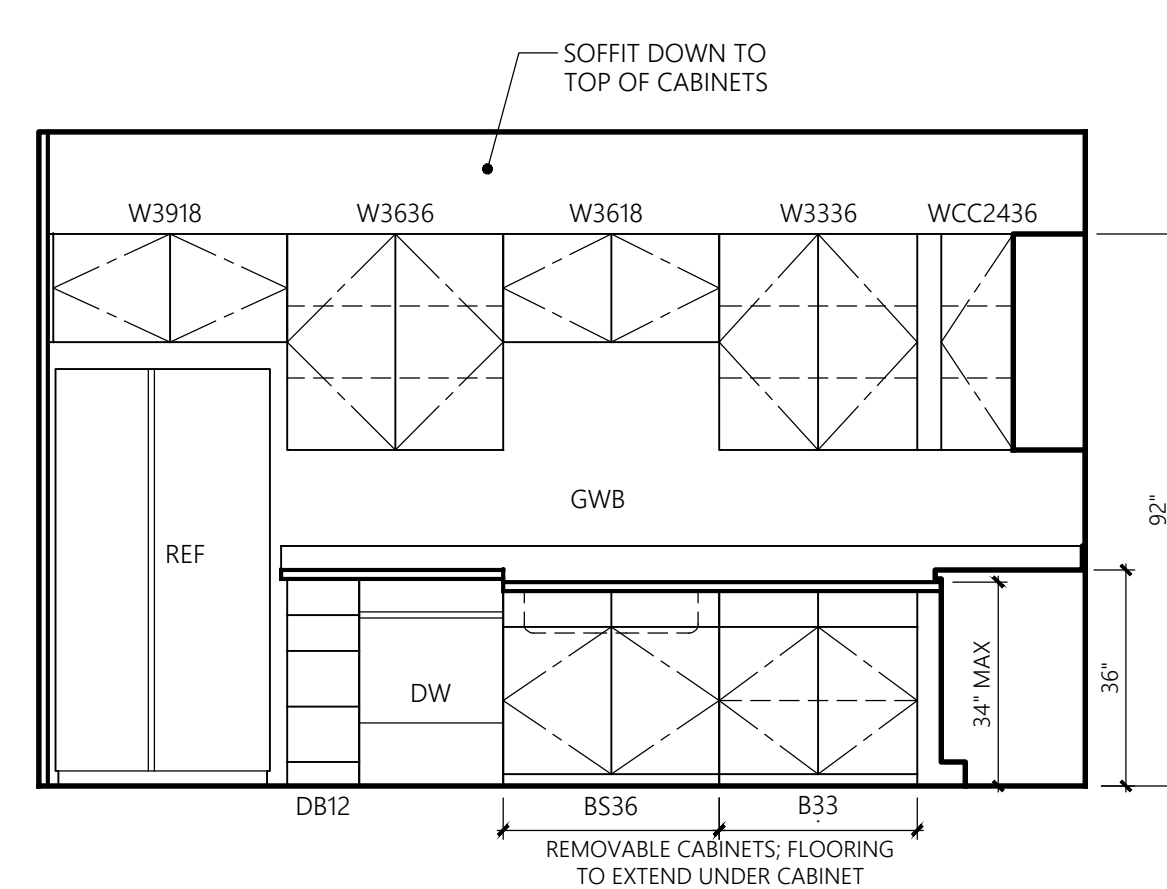

① KITCHEN

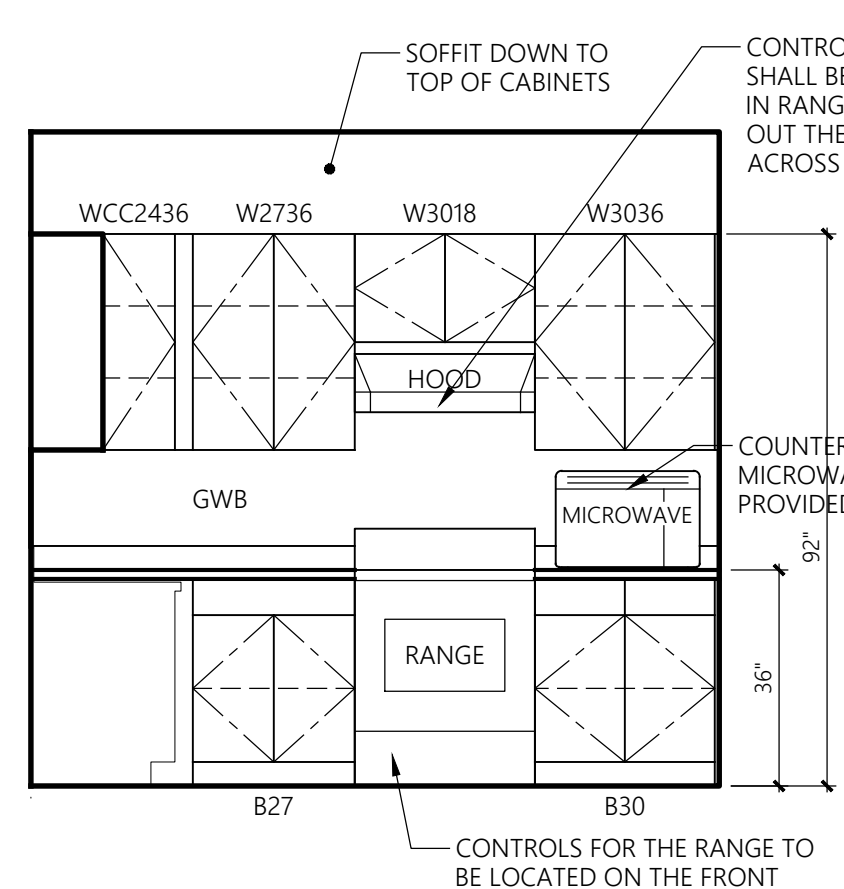


② KITCHEN

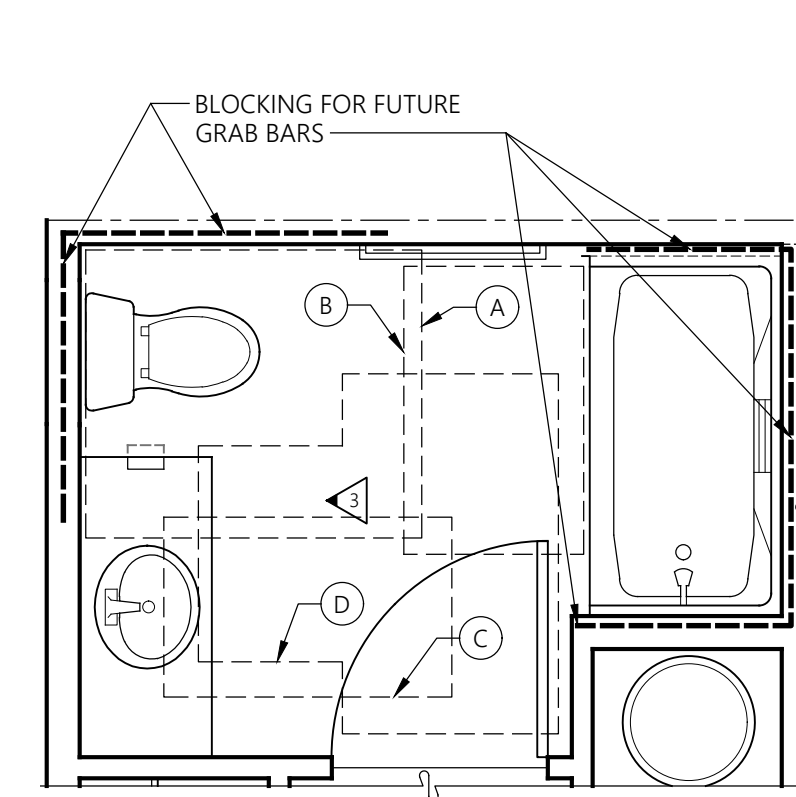


2-BED UNIT

3/8" = 1'-0"

TYPE 'A'
MAIN BATHROOM PLAN

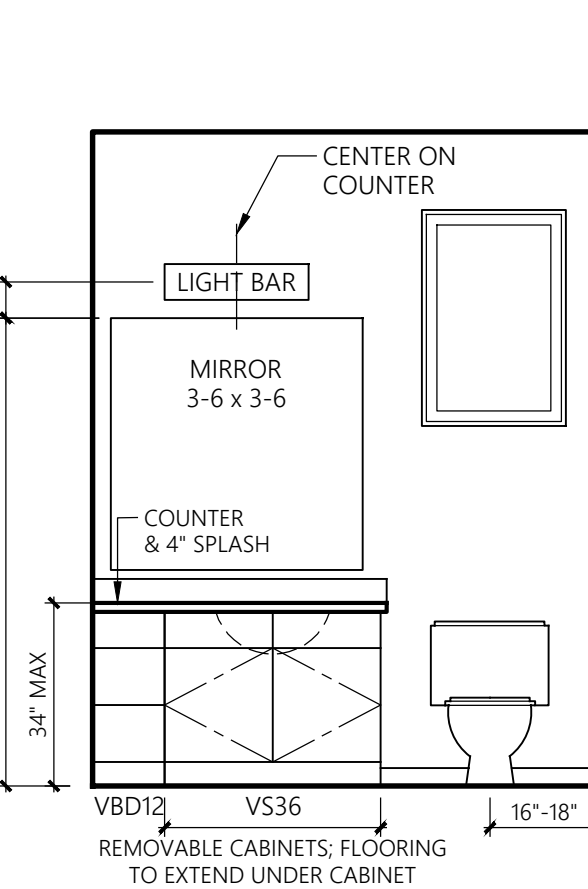


③ MAIN BATH

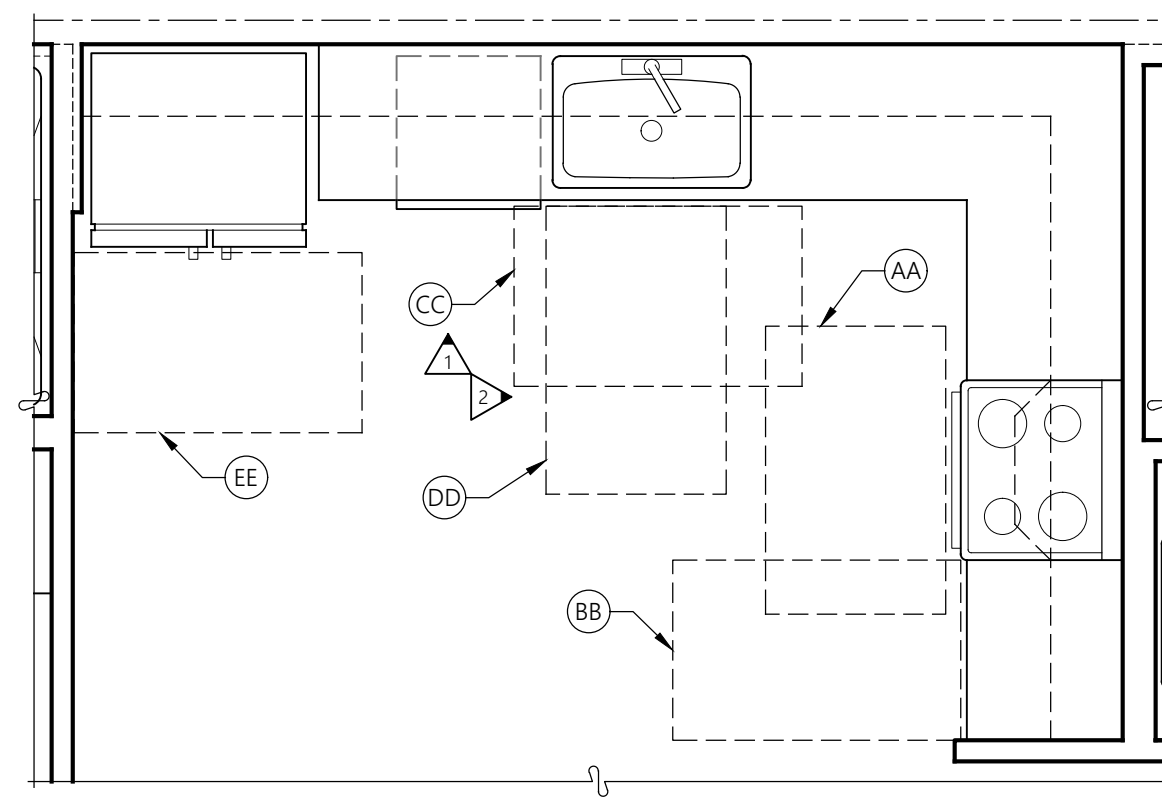


2-BED UNIT

3/8" = 1'-0"


TYPE 'B'
KITCHEN PLAN

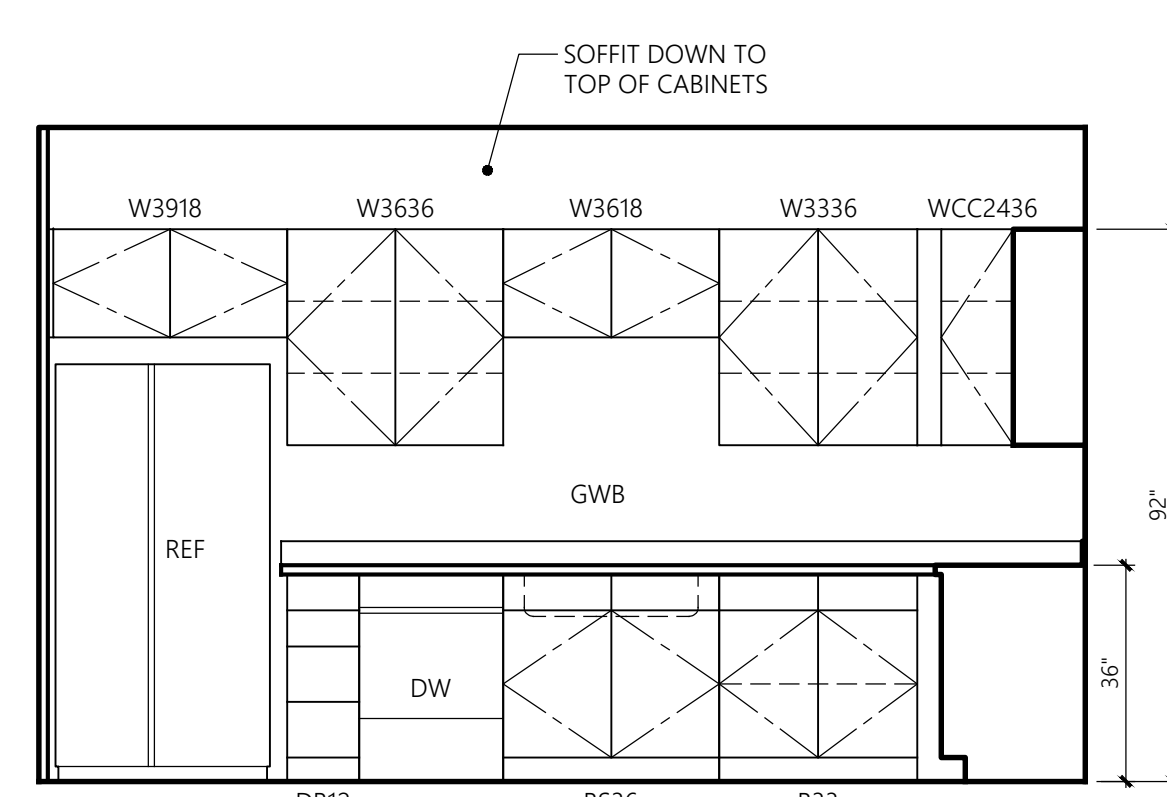

① KITCHEN

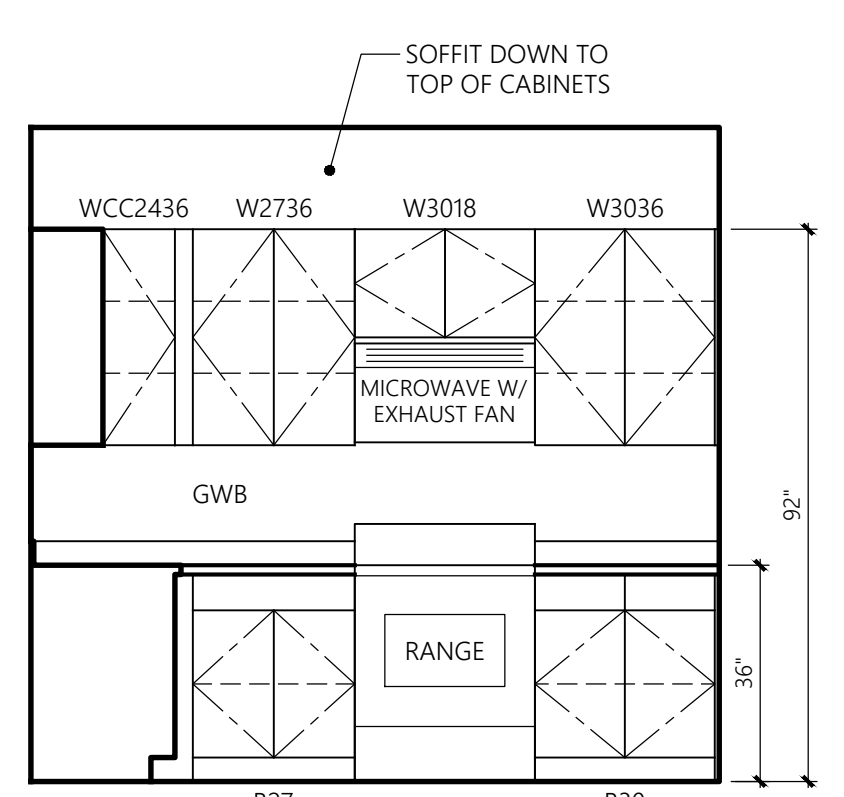


② KITCHEN

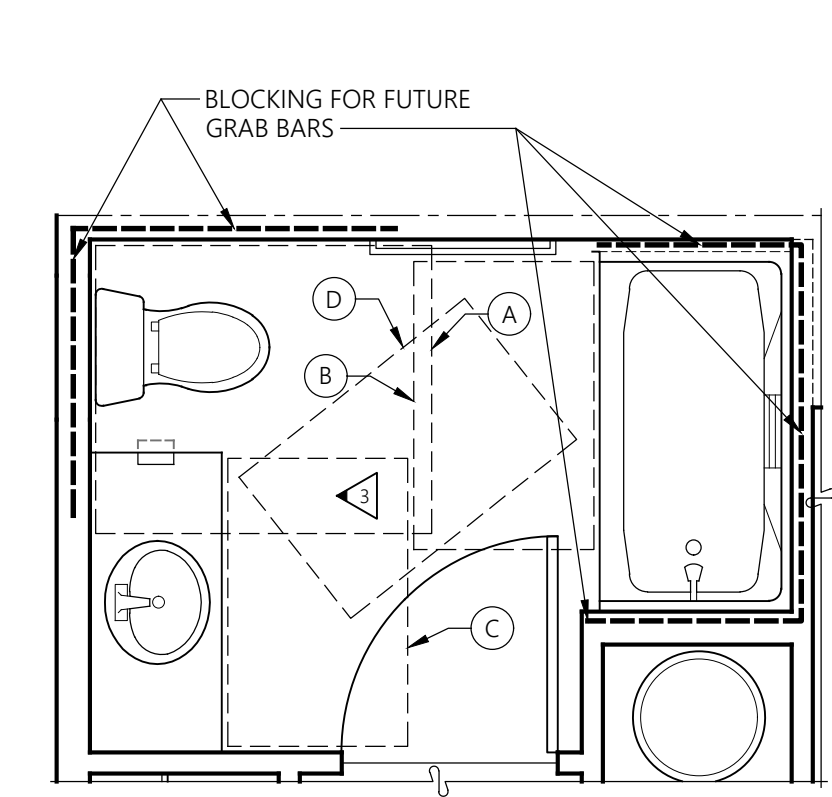


2-BED UNIT BATHROOM PLAN

3/8" = 1'-0"

TYPE 'B' ACCESSIBLE UNIT

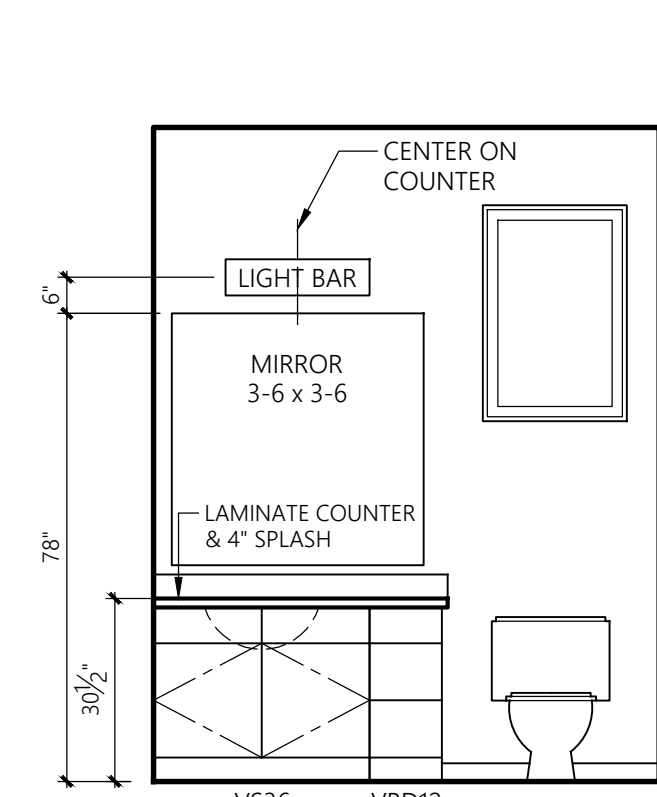


③ BATH

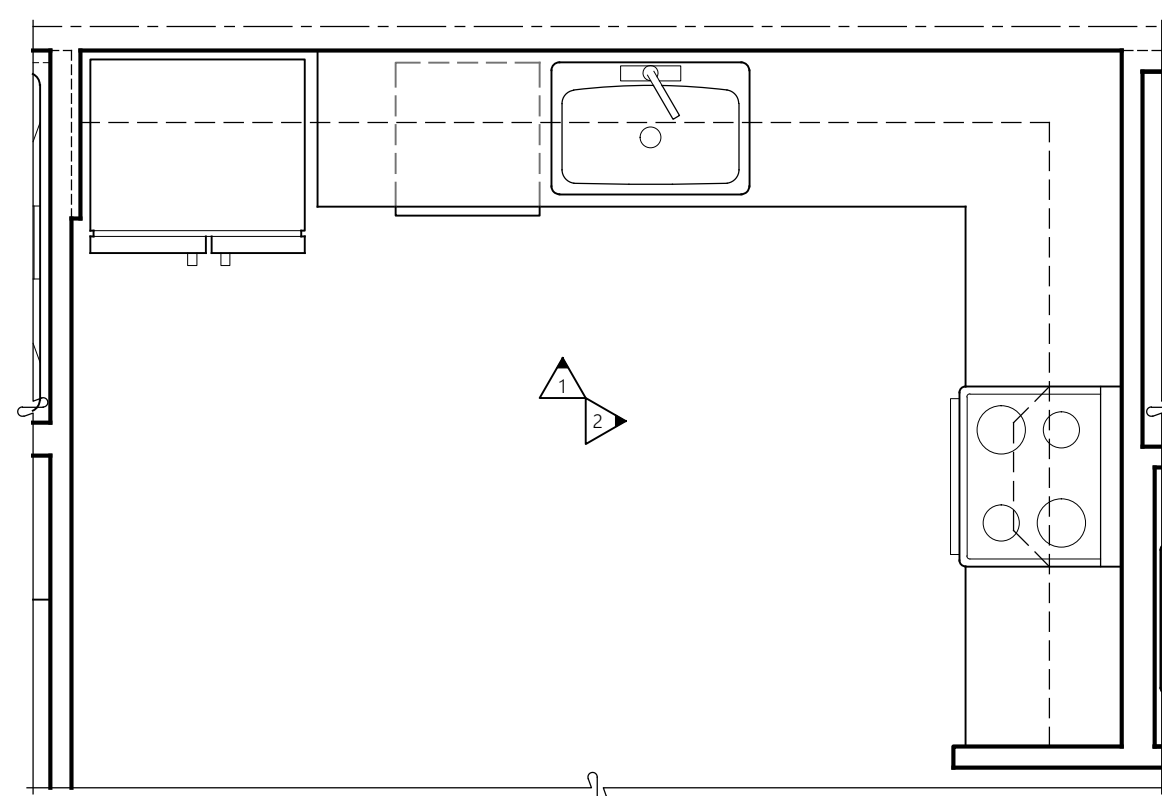


2-BED UNIT

3/8" = 1'-0"


NON-ACCESSIBLE
KITCHEN PLAN

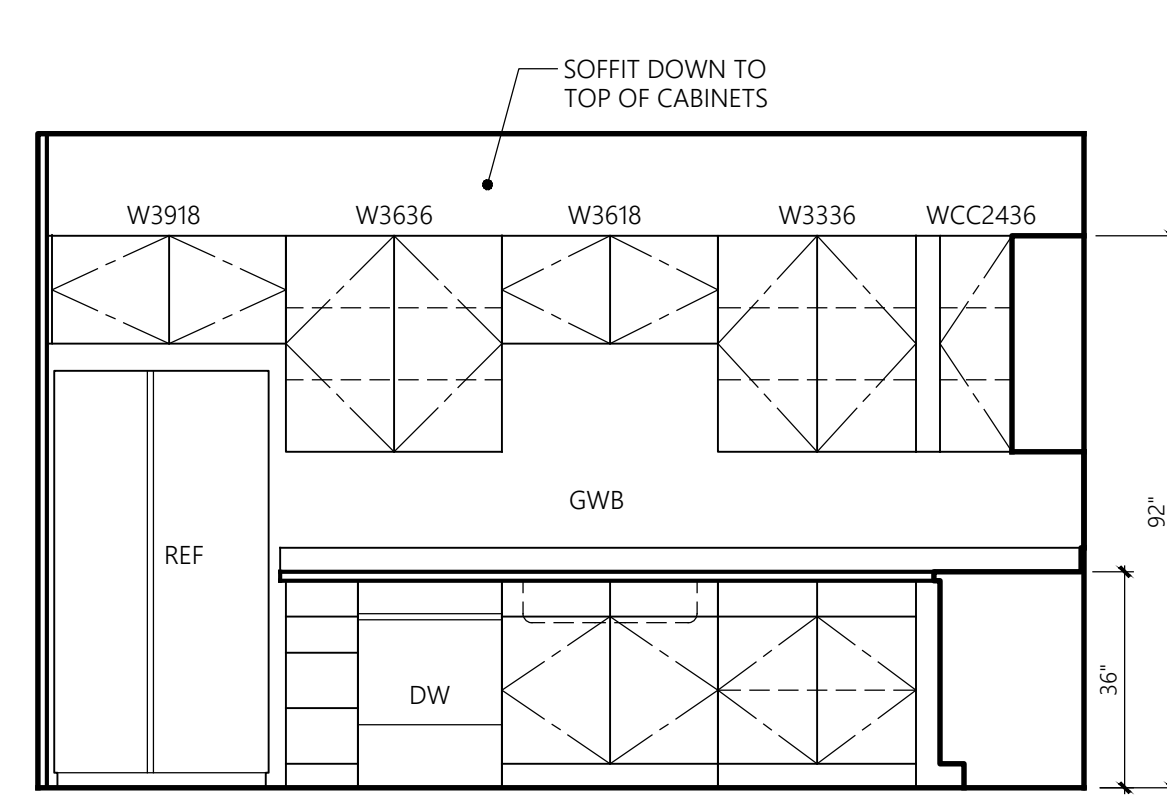

① KITCHEN

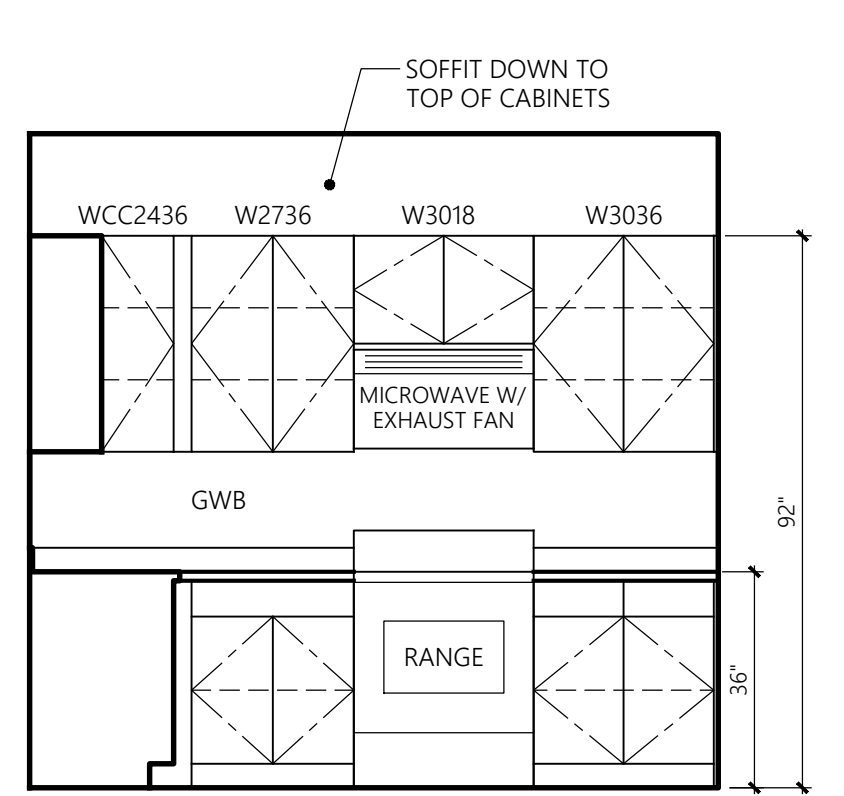


② KITCHEN

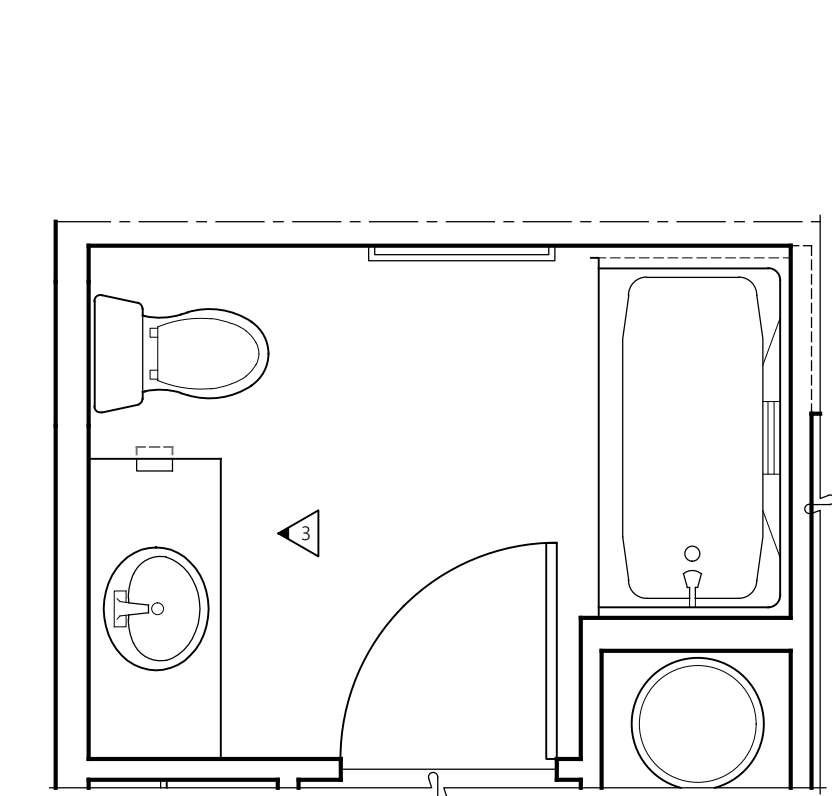


2-BED UNIT NON-ACCESSIBLE
BATHROOM PLAN

3/8" = 1'-0"

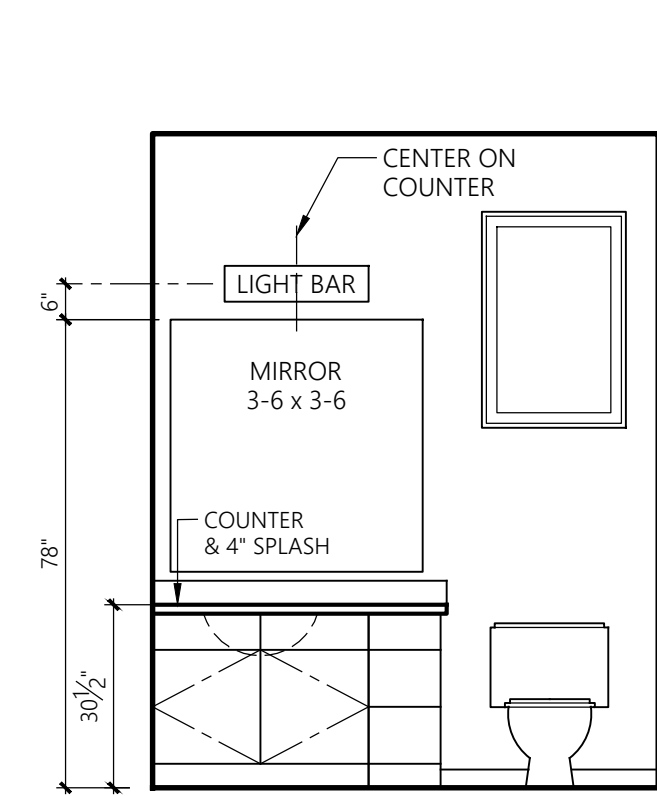


③ BATH

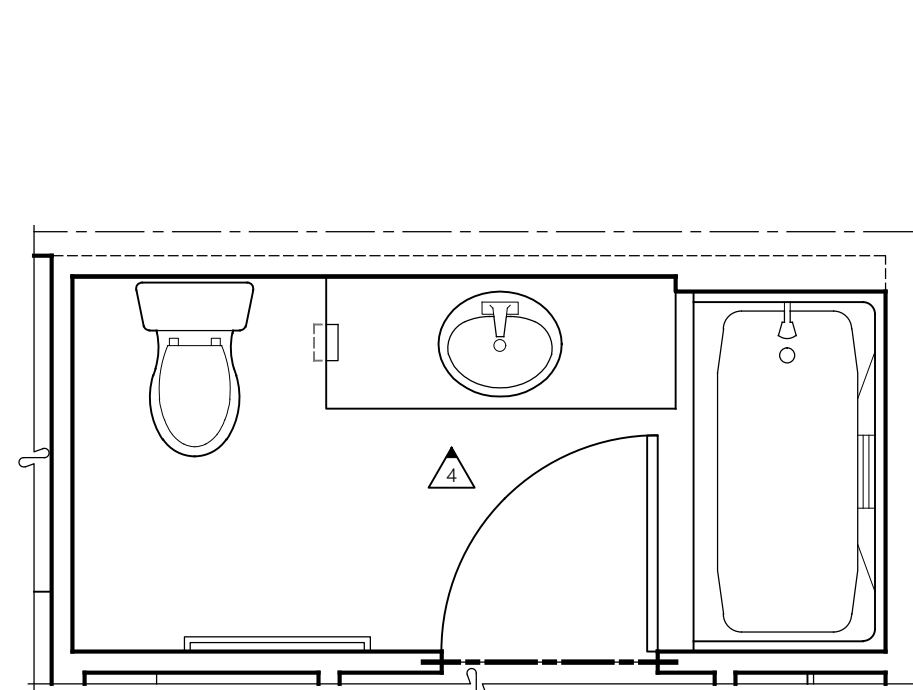

2-BED UNIT

3/8" = 1'-0"

TYPE 'A' & 'B' & NON-ACCESSIBLE
SECONDARY BATHROOM PLAN

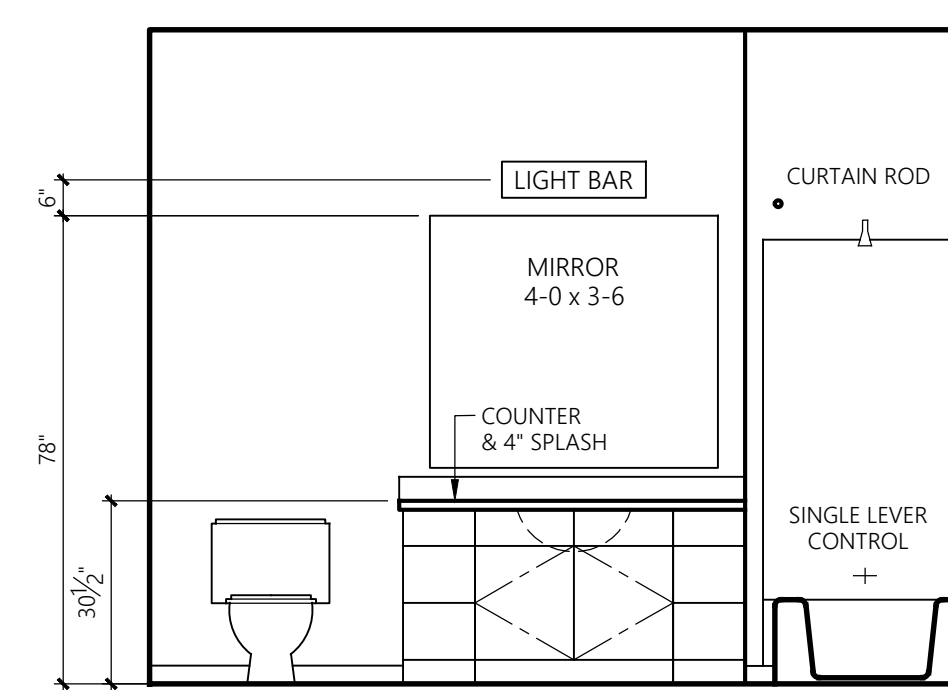


④ SECONDARY

*SEE SHEET U9
FOR
ACCESSIBILITY
STANDARDS


CLEAR FLOOR SPACE LEGEND TYPE A UNIT	
(A)	60x66 CLEAR FLOOR SPACE AT TOILET.
(B)	30x60 CLEAR FLOOR SPACE AT TUB.
(C)	30"x48" CLEAR FLOOR SPACE CENTERED ON SINK
(D)	60" DIAMETER TURNING CIRCLE OR T-SHAPE TURNING SPACE
(AA)	30x48 CLEAR FLOOR SPACE AT STOVE.
(BB)	30x48 CLEAR FLOOR SPACE AT OVEN.
(CC)	30x48 CLEAR FLOOR SPACE AT SINK.
(DD)	30x48 CLEAR FLOOR SPACE AT DISHWASHER.
(EE)	30x48 CLEAR FLOOR SPACE AT REFRIGERATOR.
(FF)	30x48 CLEAR FLOOR SPACE AT WORK SURFACE.
(GG)	30x48 CLEAR FLOOR SPACE AT WASHER/DRYER

CLEAR FLOOR SPACE LEGEND TYPE B UNIT	
(A)	48x56 CLEAR FLOOR SPACE AT TOILET.
(B)	30x48 CLEAR FLOOR SPACE AT TUB.
(C)	30"x48" CLEAR FLOOR SPACE CENTERED ON SINK
(D)	30"x48" CLEAR FLOOR SPACE BEYOND ARC OF DOOR.
(AA)	30x48 CLEAR FLOOR SPACE AT STOVE.
(BB)	30x48 CLEAR FLOOR SPACE AT OVEN.
(CC)	30x48 CLEAR FLOOR SPACE AT SINK.
(DD)	30x48 CLEAR FLOOR SPACE AT DISHWASHER.
(EE)	30x48 CLEAR FLOOR SPACE AT REFRIGERATOR.
(GG)	30x48 CLEAR FLOOR SPACE AT WASHER/DRYER

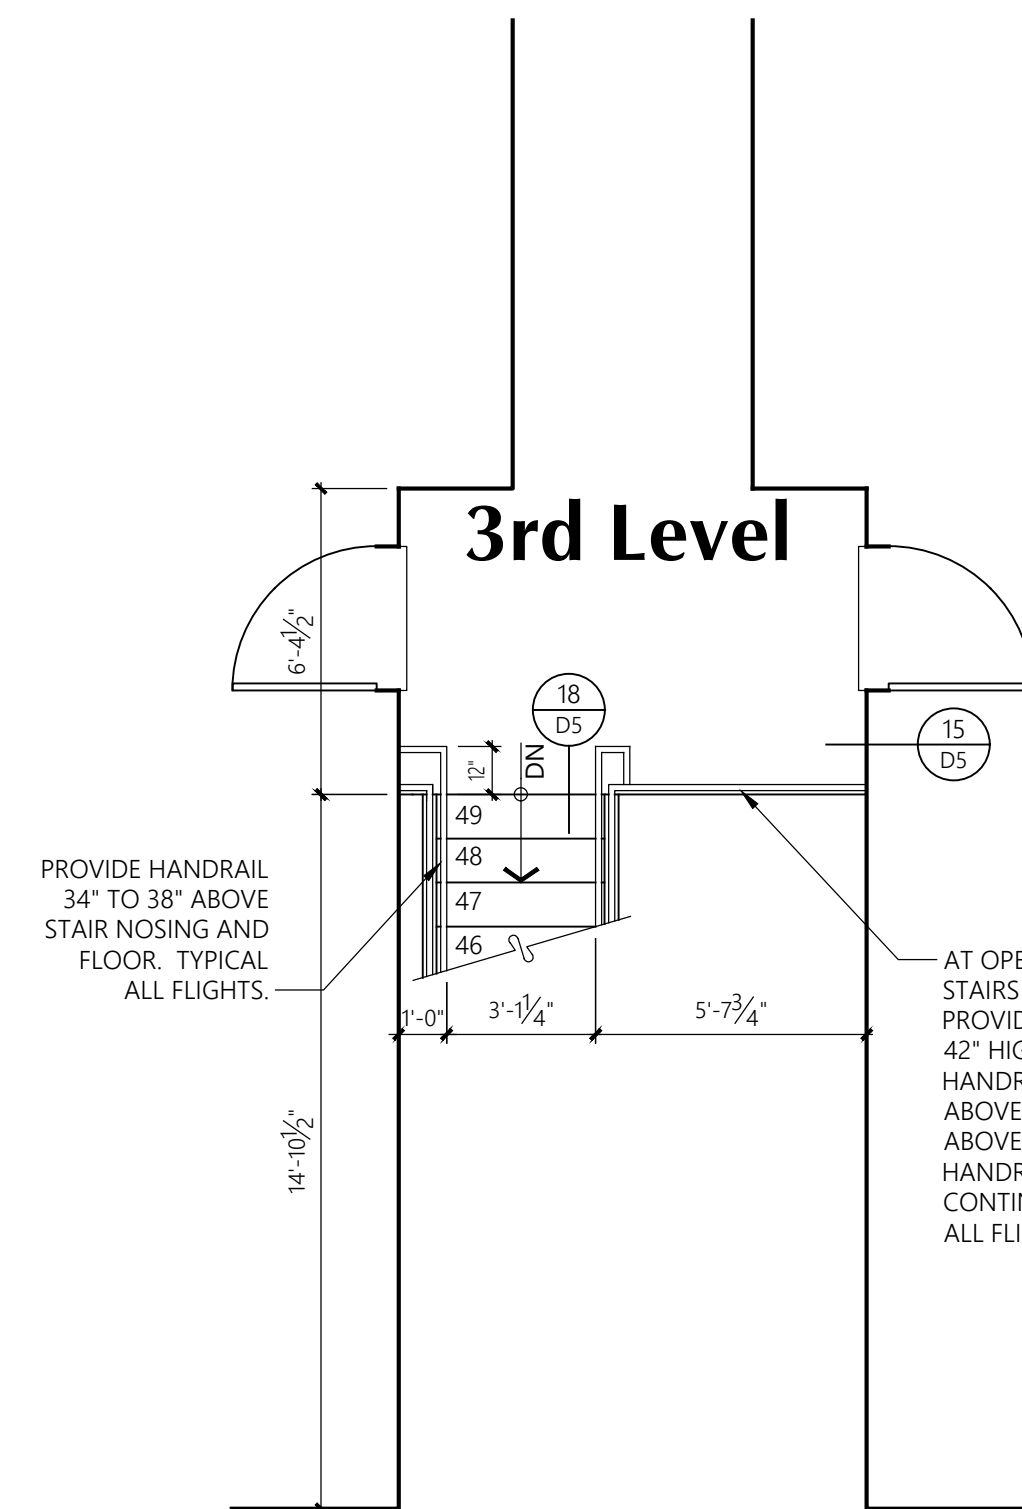


FLOOR TO FLOOR HEIGHT IS 10'-1 5/8".
18 EQUAL RISERS, RISER HEIGHT MAX. 7".
LANDING IS MIDWAY BETWEEN FLOORS

STAIR 2 3RD LEVEL FLOOR PLAN
1/4" = 1'-0"

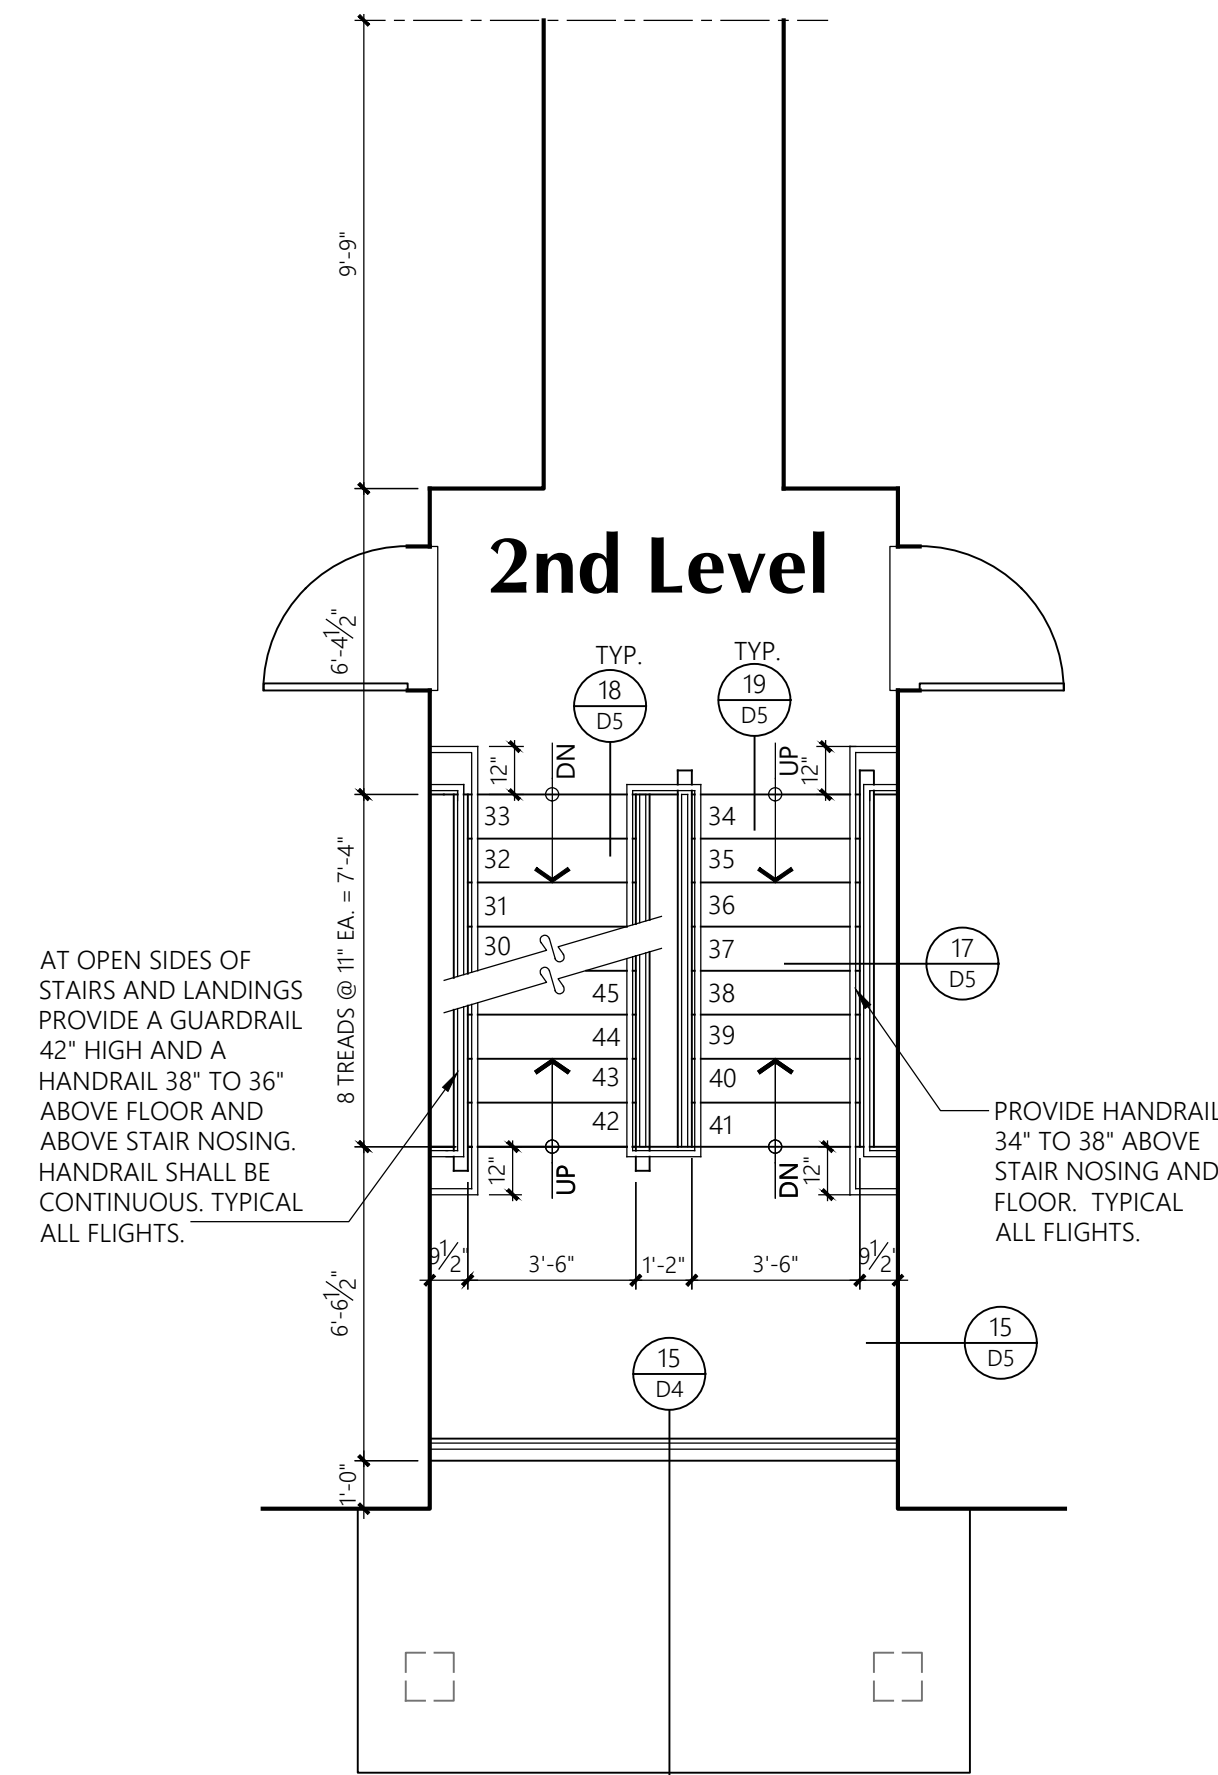


FLOOR TO FLOOR HEIGHT IS 10'-1 5/8".
18 EQUAL RISERS, RISER HEIGHT MAX. 7".
LANDING IS MIDWAY BETWEEN FLOORS

STAIR 2 2ND LEVEL FLOOR PLAN
1/4" = 1'-0"

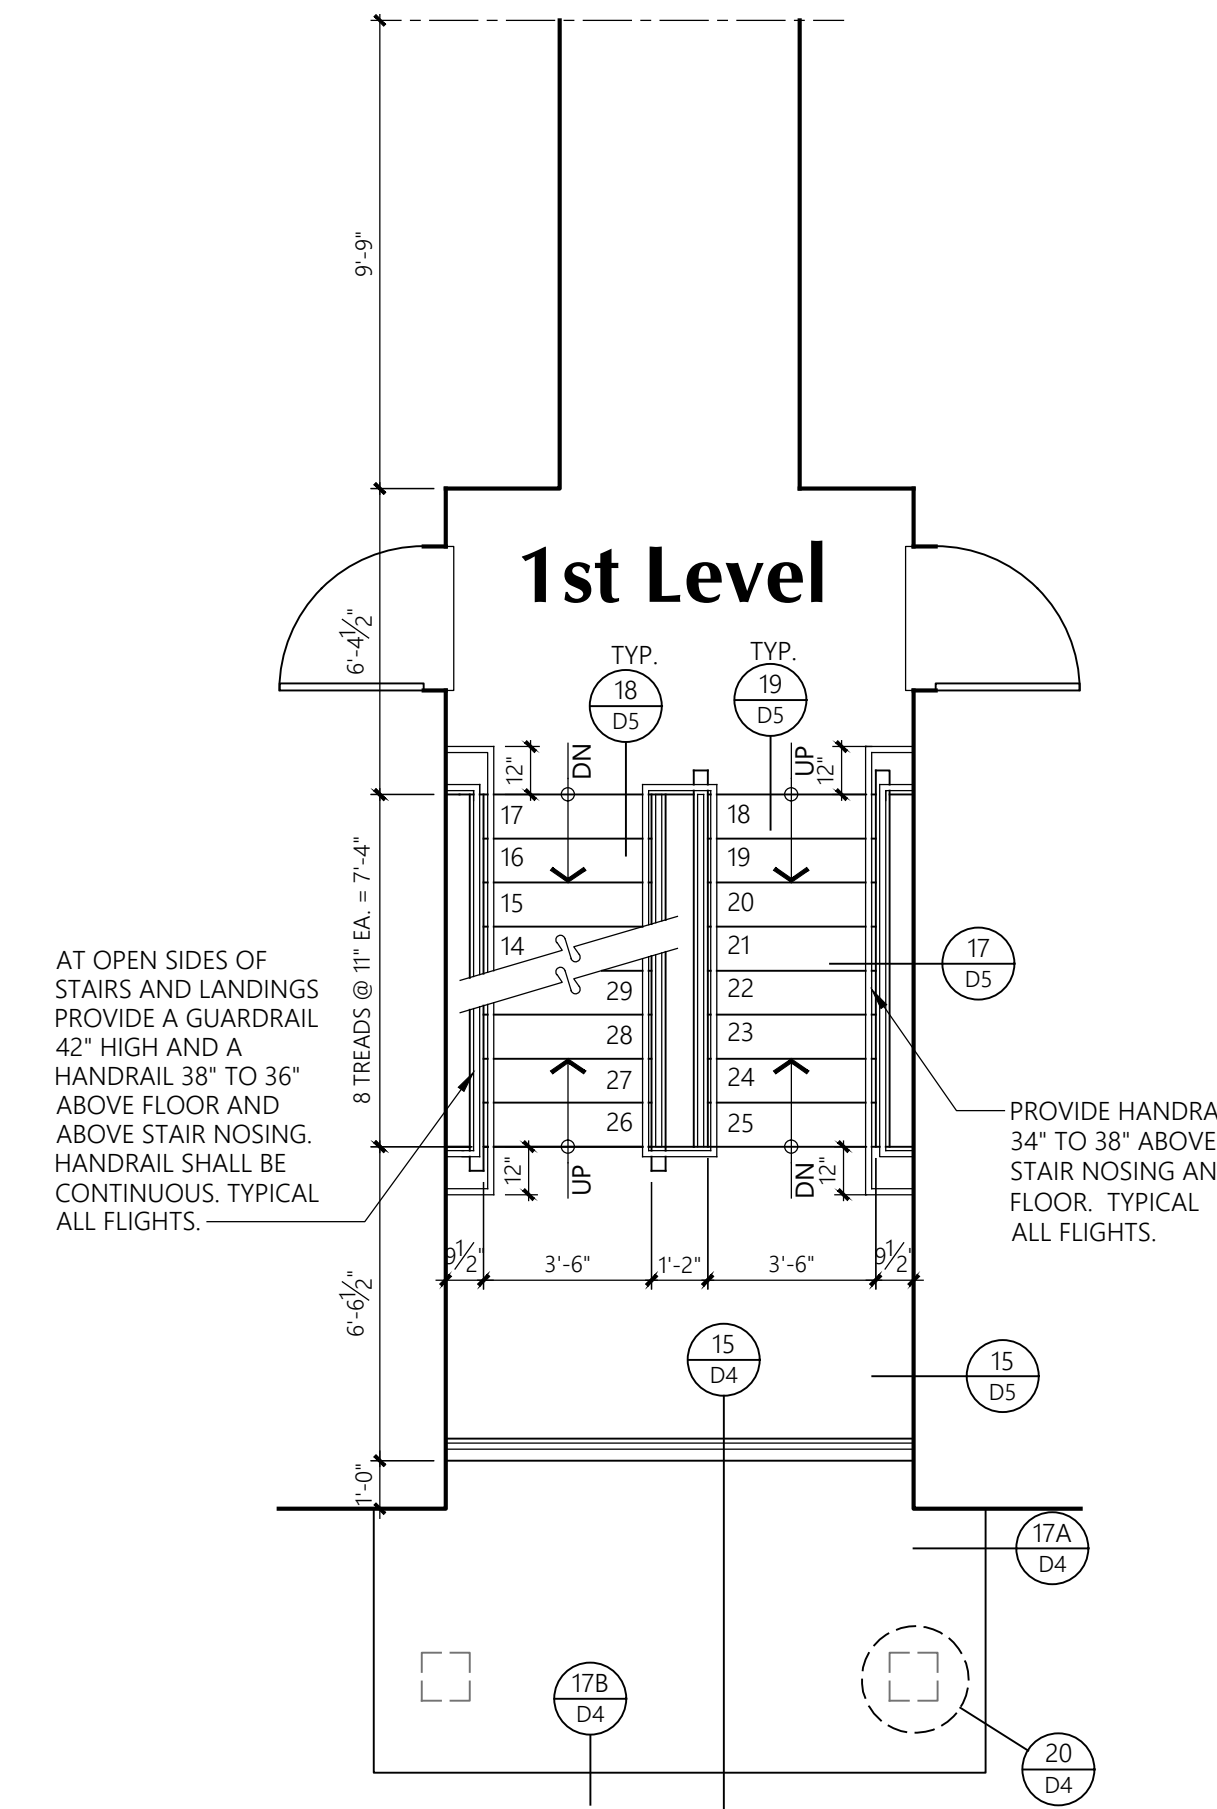


FLOOR TO FLOOR HEIGHT IS 10'-1 5/8".
18 EQUAL RISERS, RISER HEIGHT MAX. 7".
LANDING IS MIDWAY BETWEEN FLOORS


STAIR 2 1ST LEVEL FLOOR PLAN
1/4" = 1'-0"

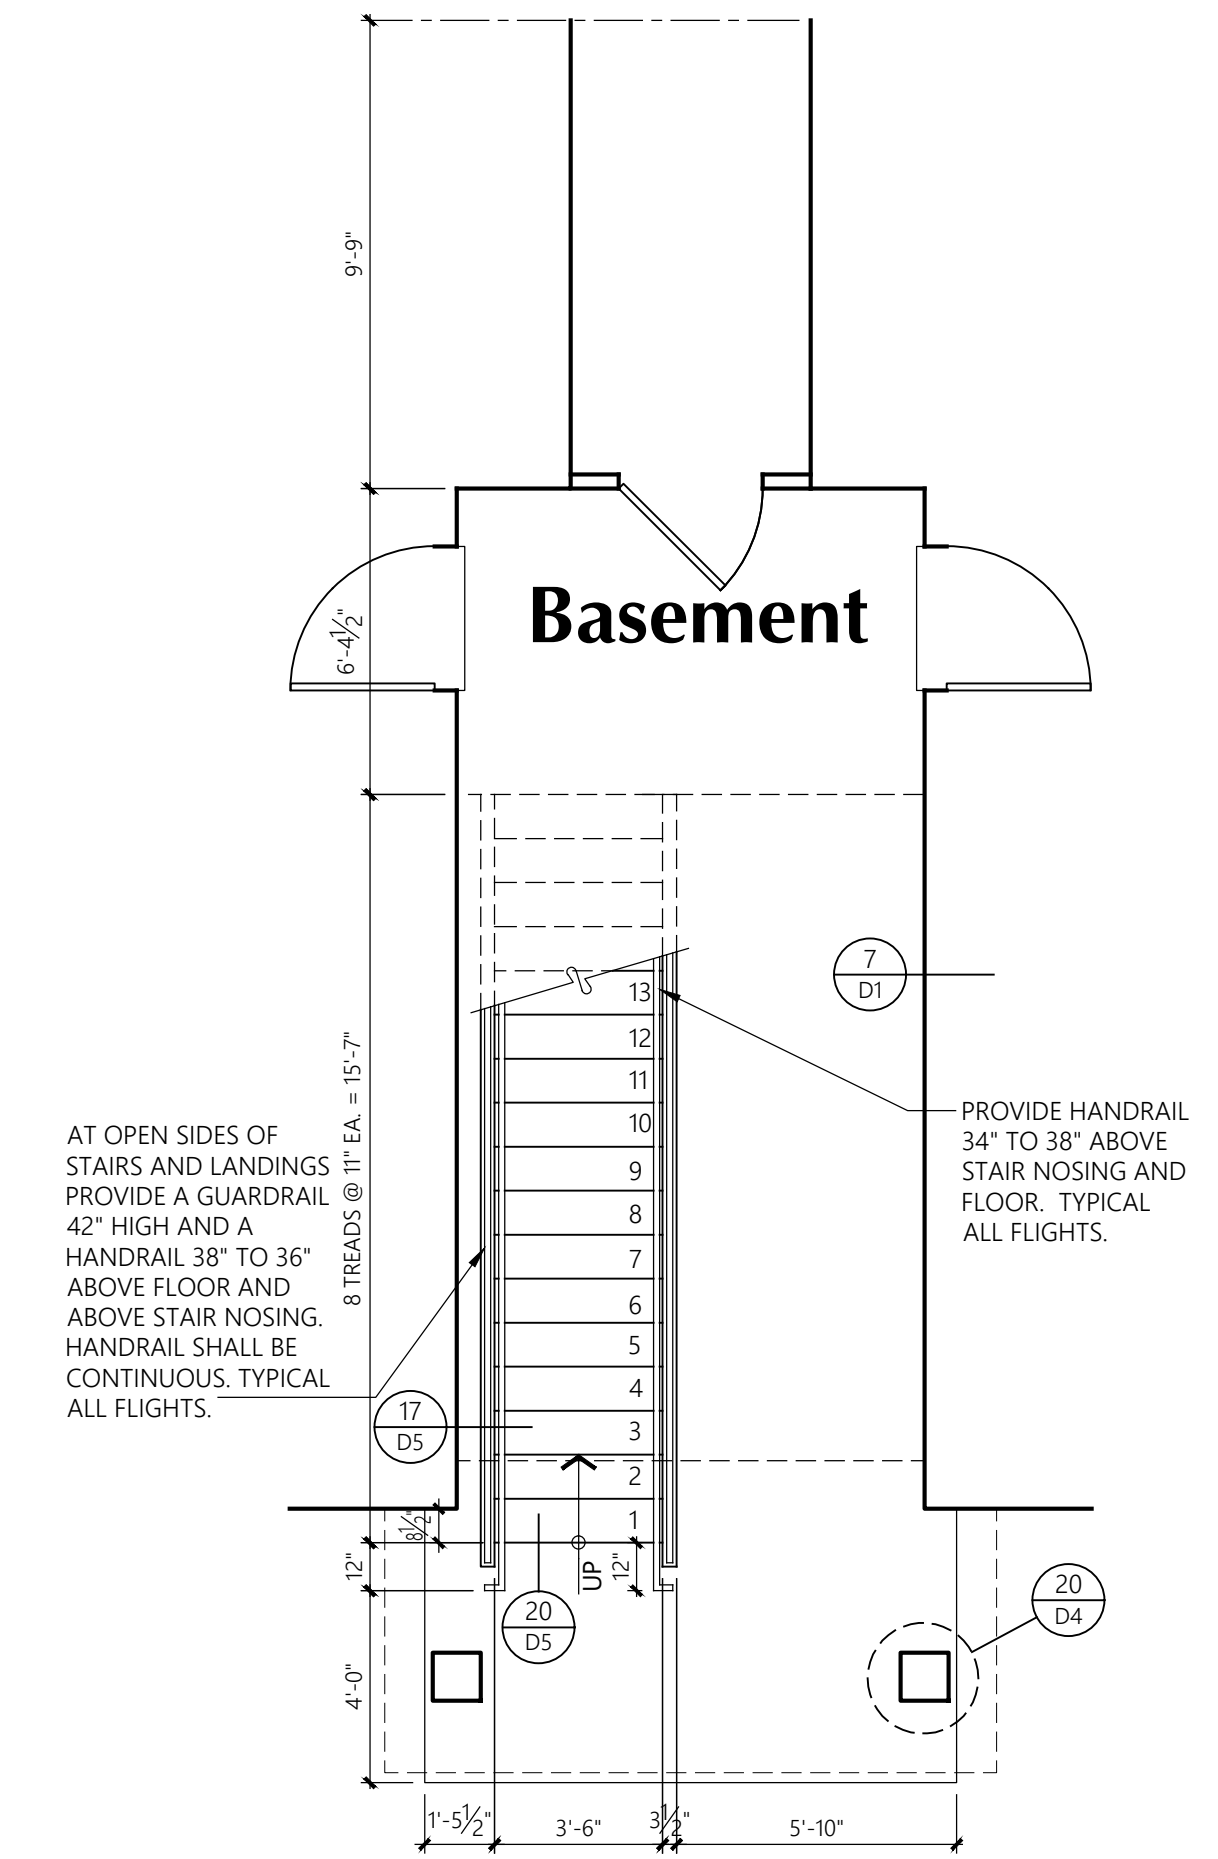

FLOOR TO FLOOR HEIGHT IS 10'-1 5/8".
18 EQUAL RISERS, RISER HEIGHT MAX. 7".
LANDING IS MIDWAY BETWEEN FLOORS

STAIR 2 BASEMENT LEVEL PLAN
1/4" = 1'-0"

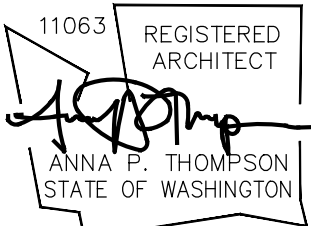

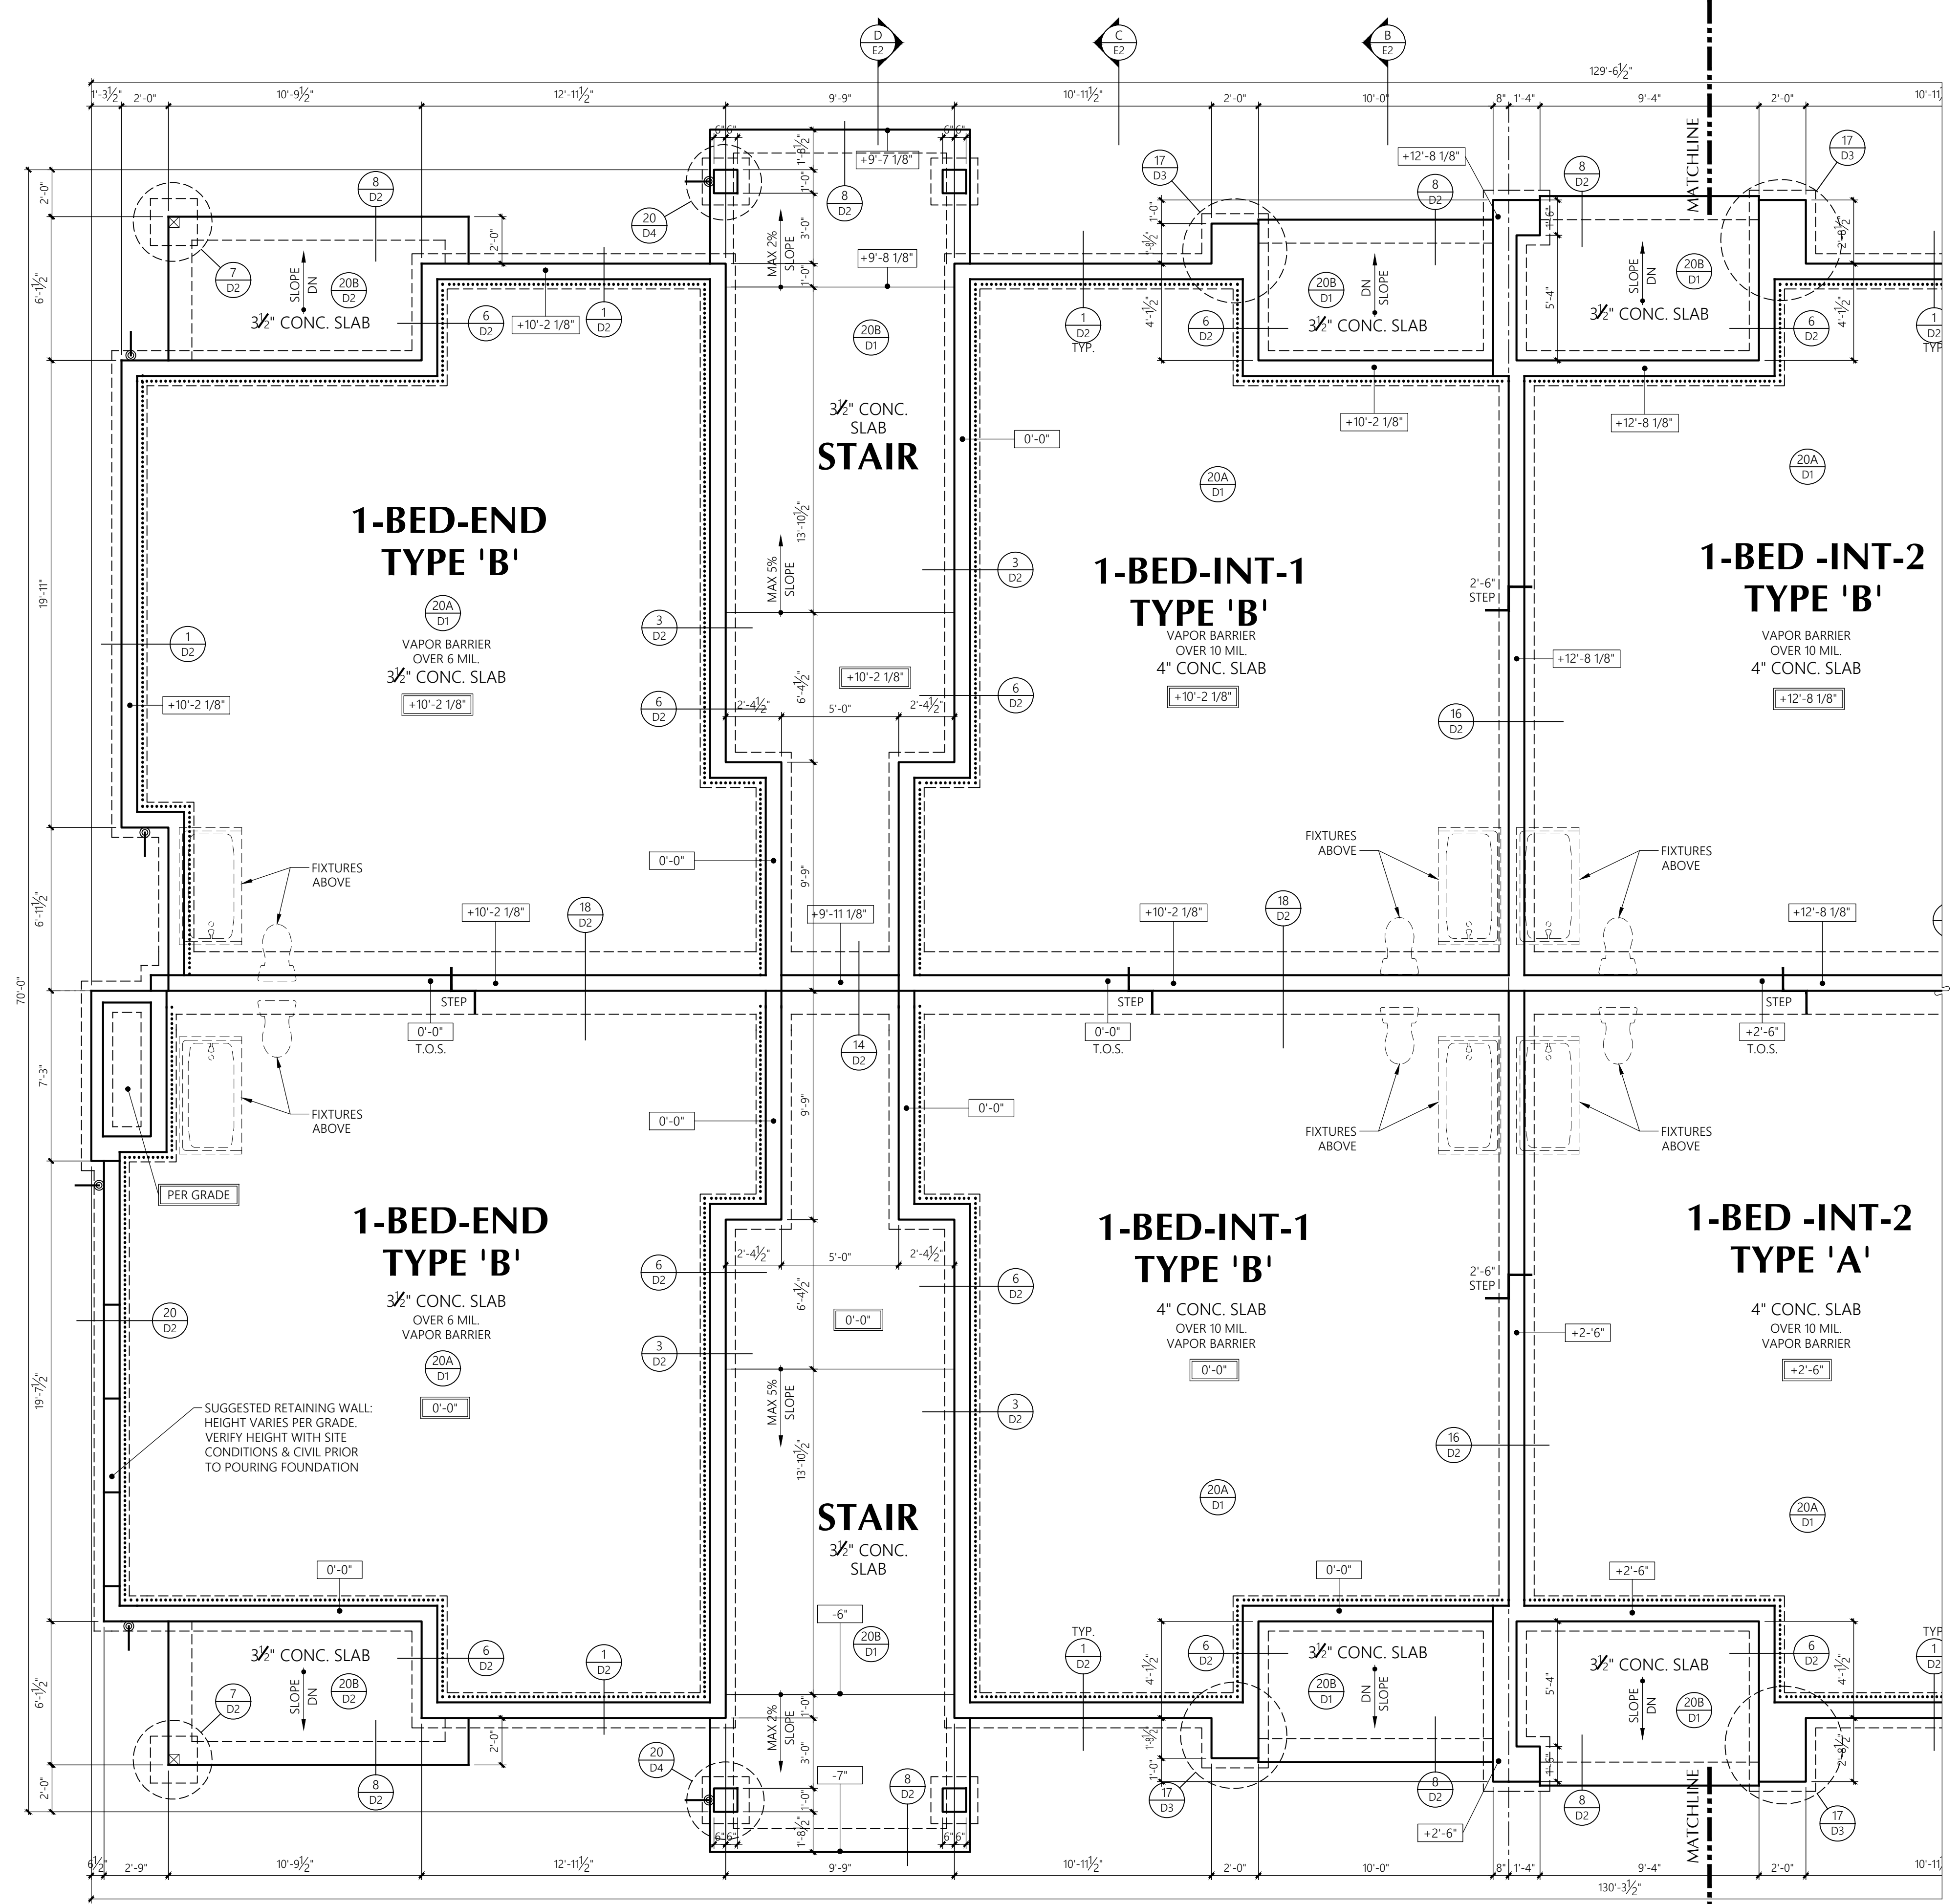

FOUNDATION NOTES

- LOCATION OF DOWNSPOUT: PROVIDE TIGHT LINE AND RISER BOOT
- ELEVATION AT TOP OF CONCRETE (TOP OF FOOTING MAY VARY BECAUSE OF EXCAVATION)
- FINISH SLAB ELEVATION
- R-10 RIGID PERIMETER INSULATION

BUILDING A PARTIAL FOUNDATION PLAN
1/4" = 1'-0"
3/4 SPLIT LEVEL, 28-UNIT BUILDING

SEE S2.6 FOR STRUCTURAL FOUNDATION PLAN

R. VASOP/VAULTING/ALDING



Building A
Partial Architectural Foundation Plan

Bradley Heights Apartments

Puyallup, Wa


Timberlane Partners

Revisions

No.	Date	Description

Initial Publish Date:
Date Plotted: 2-20-24
Job No.: 23-06
Drawn By: APT/HDM/TMK
Sheet No.:

F2

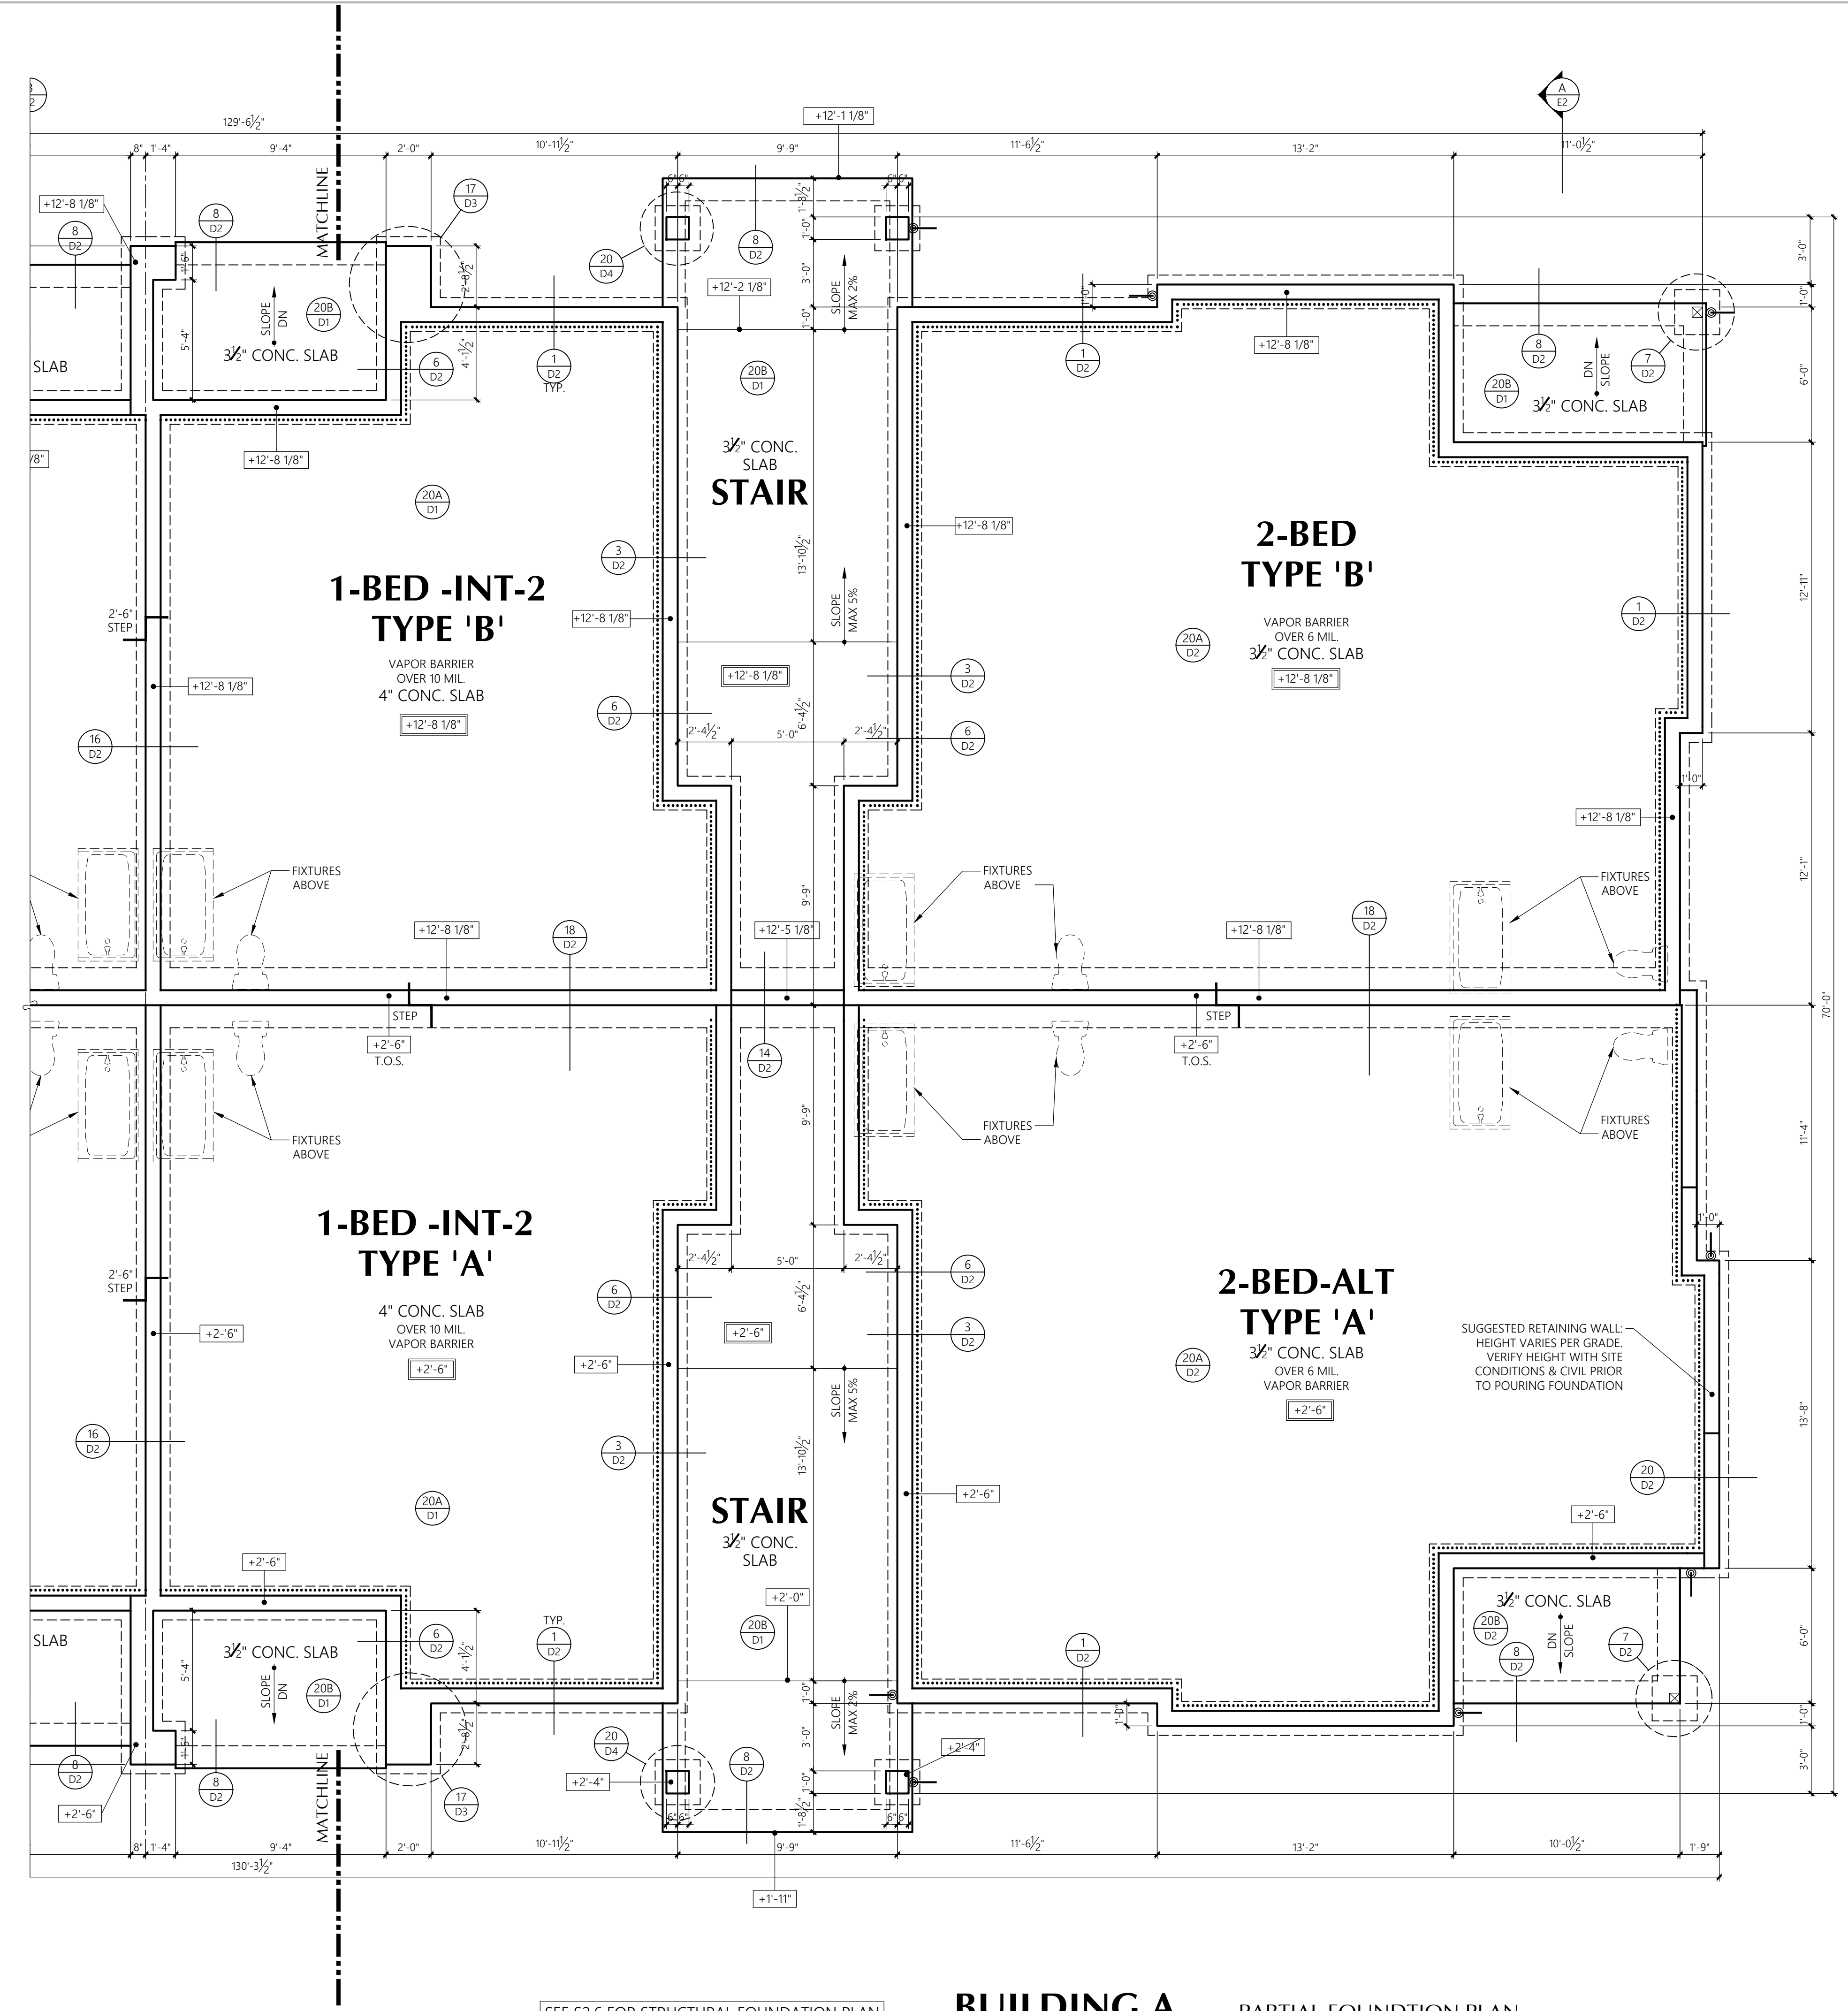

FOUNDATION NOTES

- LOCATION OF DOWNSPOUT: PROVIDE TIGHT LINE AND RISER BOOT
- ELEVATION AT TOP OF CONCRETE (TOP OF FOOTING MAY VARY BECAUSE OF EXCAVATION)
- FINISH SLAB ELEVATION
- R-10 RIGID PERIMETER INSULATION

SEE S2.6 FOR STRUCTURAL FOUNDATION PLAN

BUILDING A PARTIAL FOUNDATION PLAN
1/4" = 1'-0"
3/4 SPLIT LEVEL, 28-UNIT BUILDING



Building A
Roof Plan

Bradley Heights Apartments

Puyallup, Wa

Timberlane Partners

Revisions

No. Date Description


Initial Publish Date:

Date Plotted: 2-20-24

Job No.: 23-06 Drawn By: APT/HDM/TMK

Sheet No.:

R1

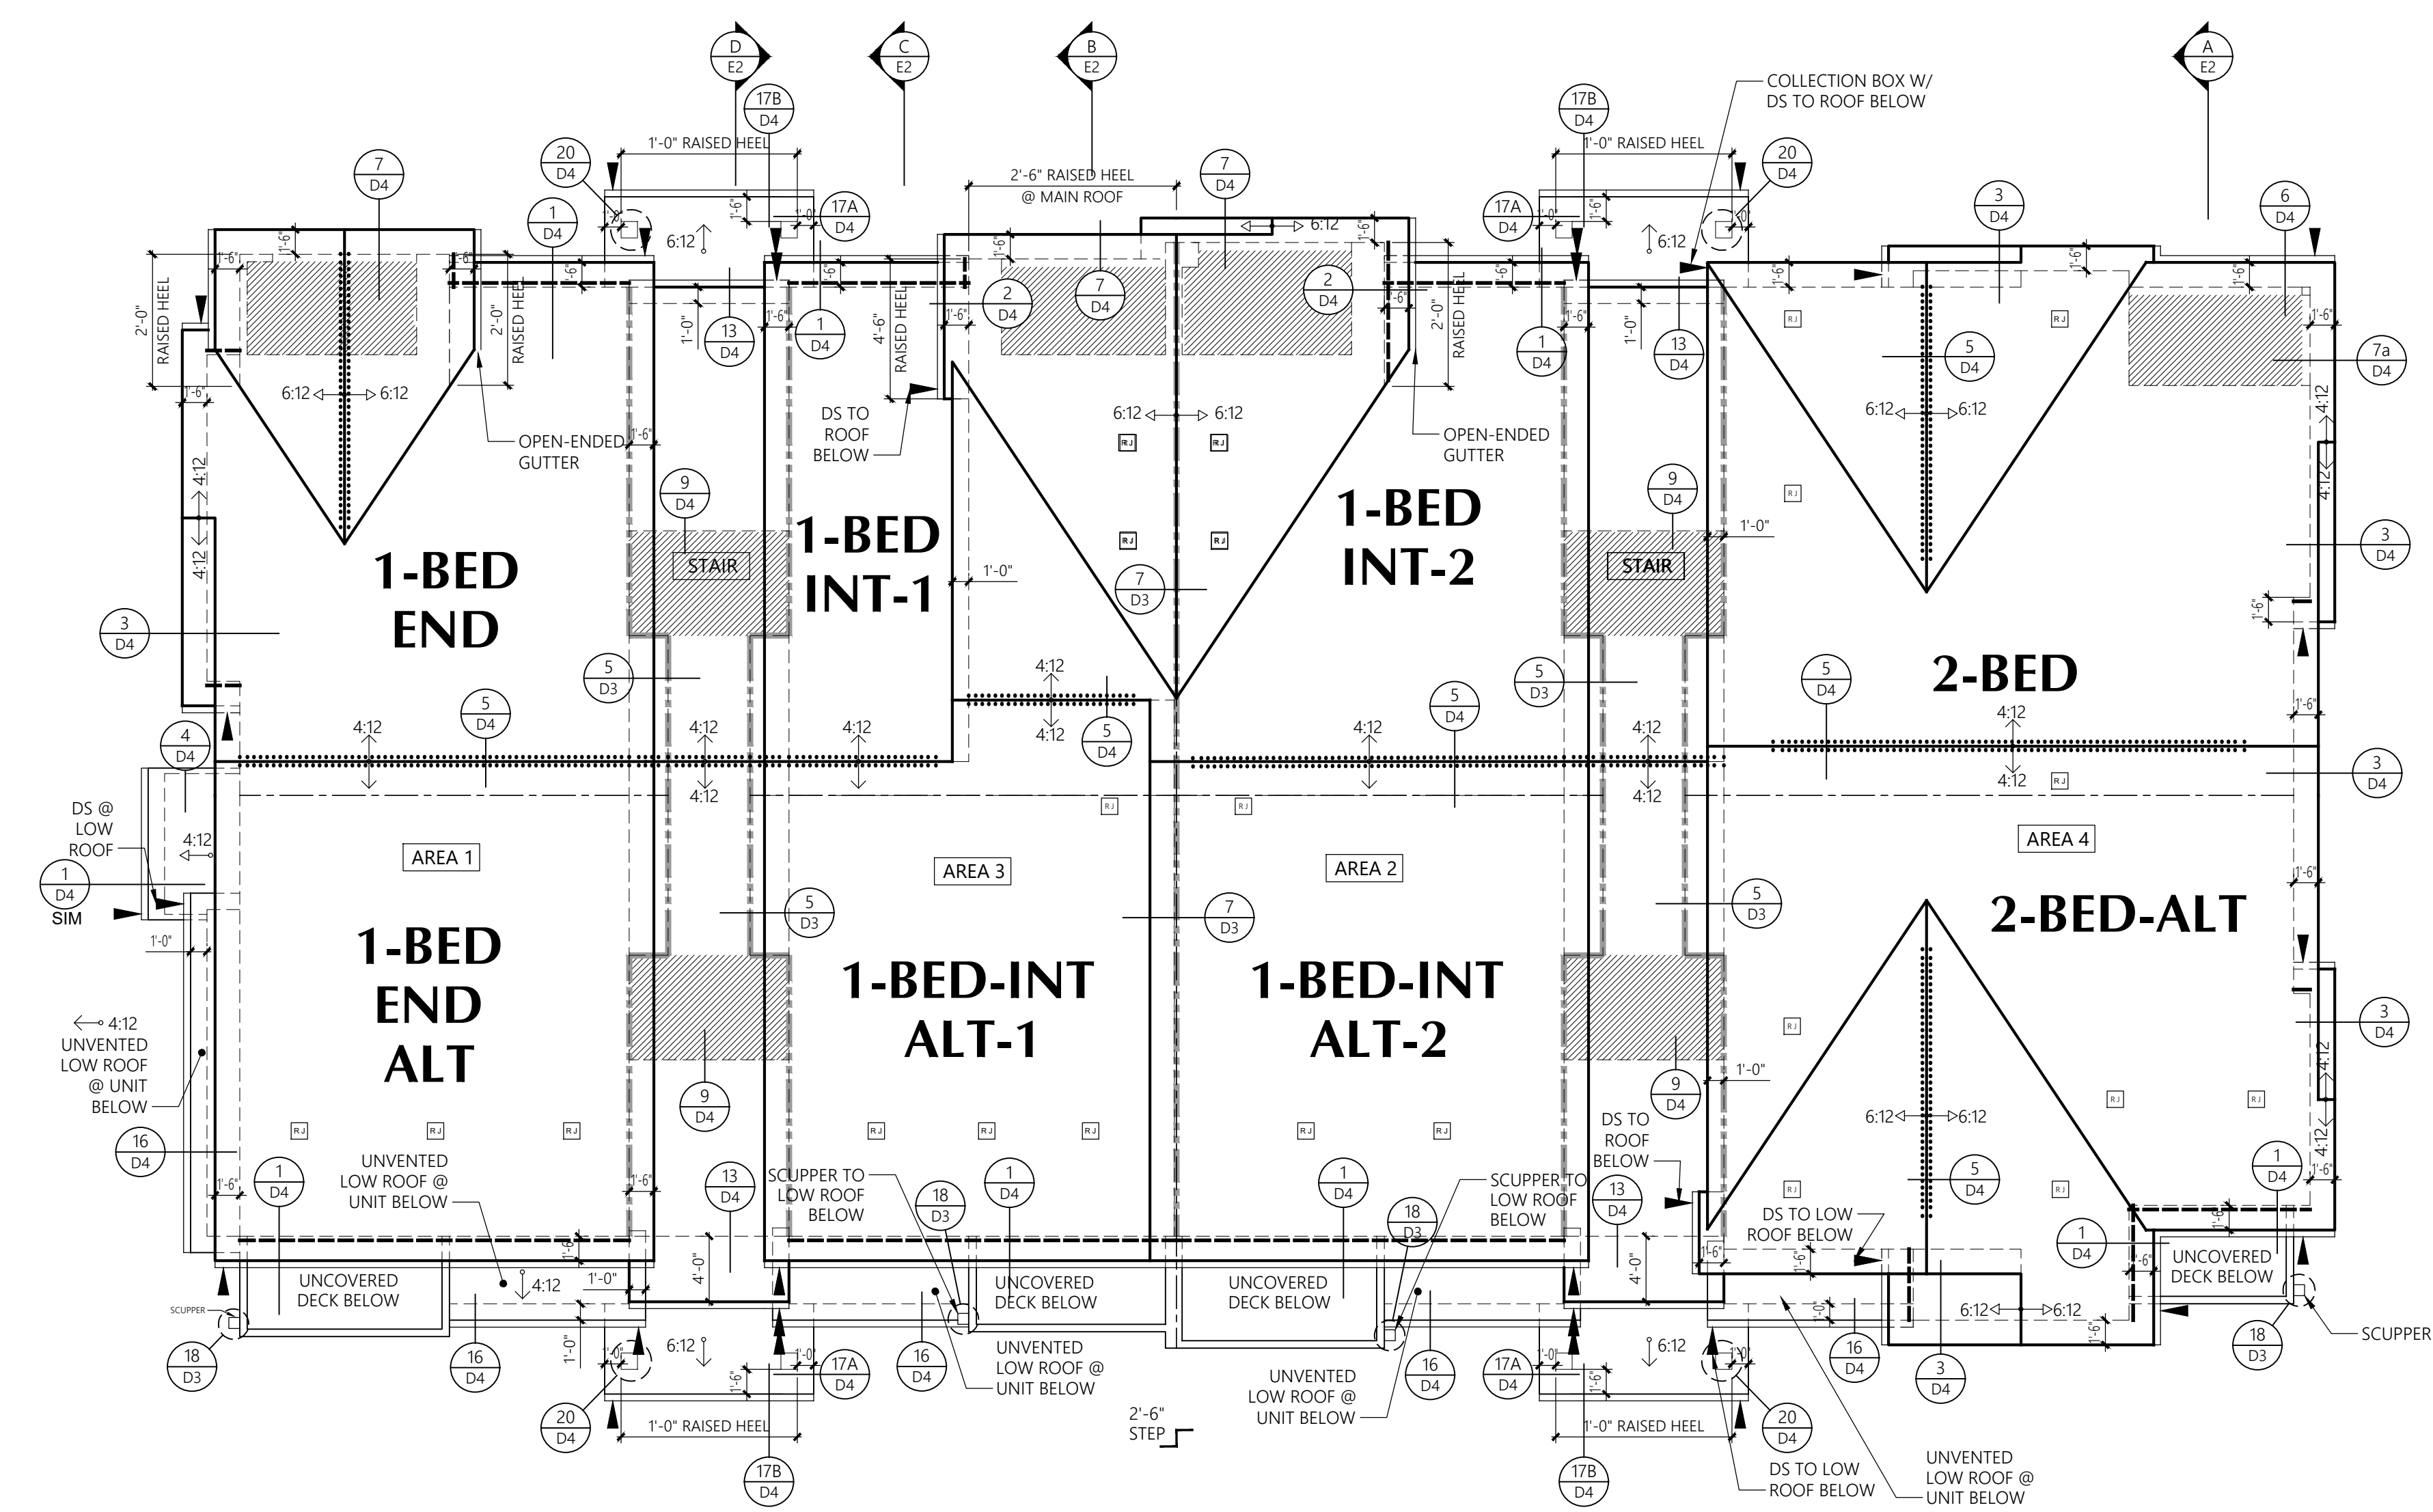


BUILDING A ROOF PLAN
1/8" = 1'-0"
3/4 SPLIT LEVEL 28-UNIT BUILDING


Area Description	Attic Area (SF)	Venting Ratio	Required Venting (SI)	ROOF VENTING CALCULATIONS					Venting Provided (SI)				* % of req'd	
				Low Eave Vent (LF)	Low Jacks (Qty)	High Jacks (Qty)	Vented Soffit (SF)	Ridge Vent (LF)	Lower	%	Upper	%		Total
AREA 1	1,486	1/300	713	38	3	0	58	41	583	54%	492	46%	1,075	151%
AREA 2	1,448	1/300	695	40	2	5	64	24	574	52%	538	48%	1,112	160%
AREA 3	1,435	1/300	689	32	3	5	53	20	540	52%	490	48%	1,030	150%
AREA 4	2,160	1/300	1,037	20	8	1	58	62	790	50%	794	50%	1,584	153%
STAIR	462	1/150	444	0	0	0	124	5	732	92%	60	8%	792	179%

ROOF LEGEND


- ROOF JACK 50 SQ.IN. NET FREE AREA
- 4:12 SLOPE INDICATOR U.N.O.
- 6:12 SLOPE INDICATOR U.N.O.
- BUILDING OUTLINE
- EAVE VENTING 2.4 SQ.IN./L.F. NET FREE AREA
- RIDGE VENTING 12 SQ.IN./L.F. NET FREE AREA
- UNIT SEPARATION AND DRAFT STOPPING LOCATIONS AT ATTIC
- GUTTER (DOUBLE LINE)
- DOWNSPOUT LOCATION
- VENTED FIBER CEMENT SOFFIT 5.9 SQ.IN./L.F. NET FREE AREA

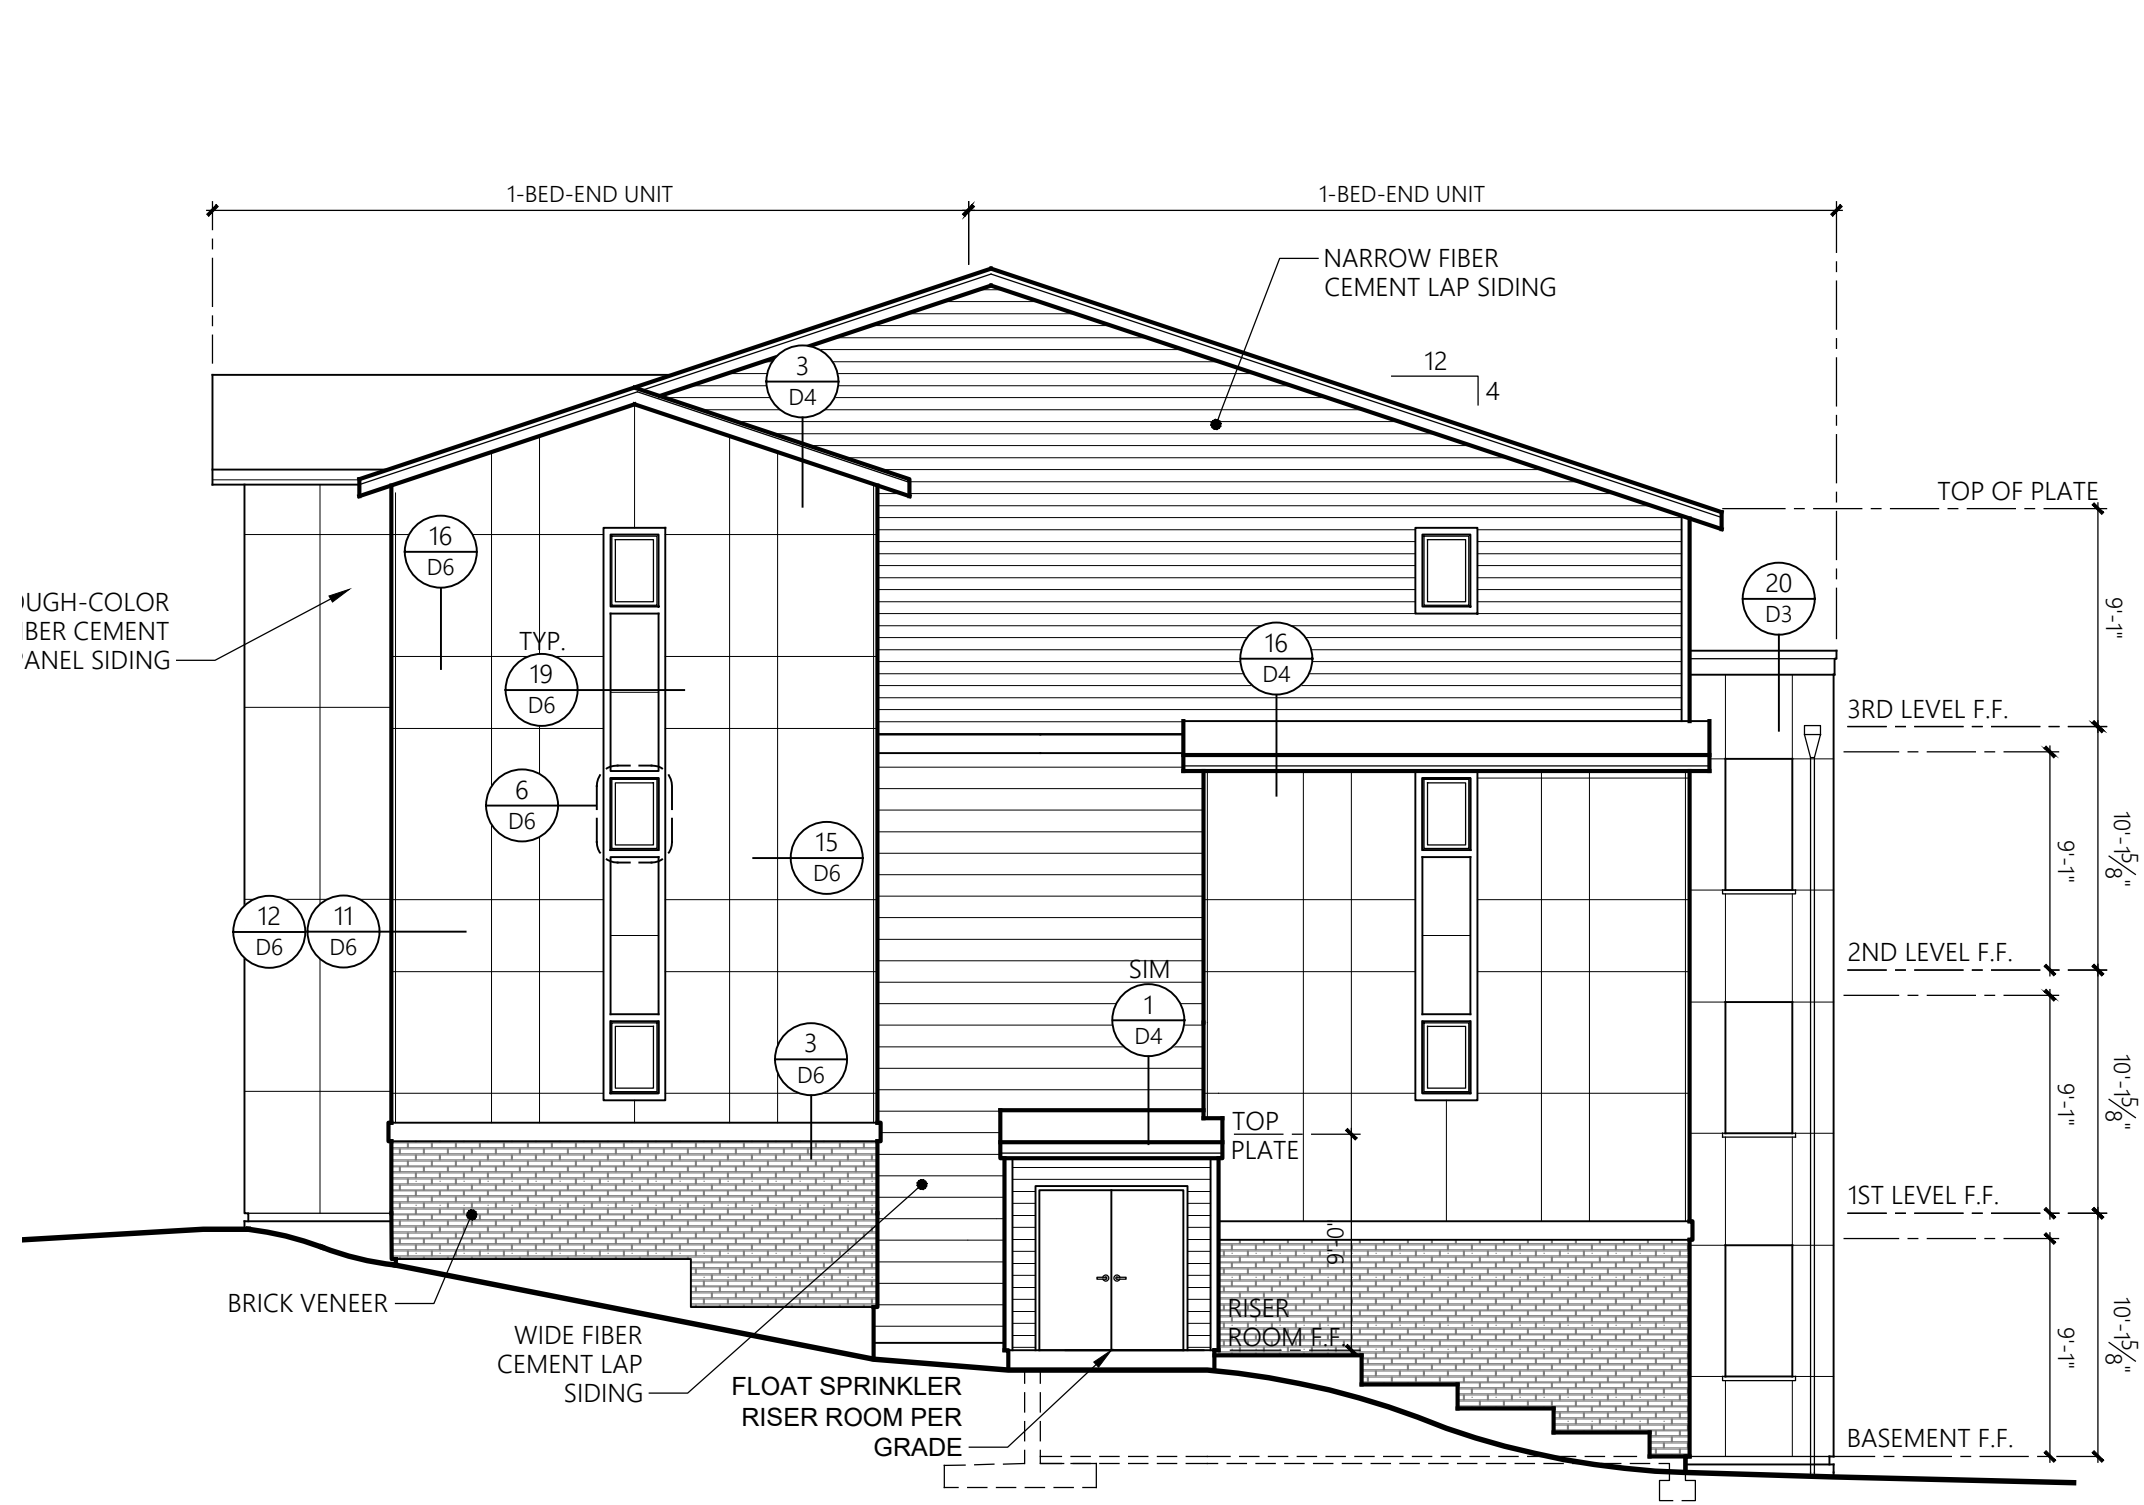


BUILDING A SIDE ELEVATION
1/8" = 1'-0"

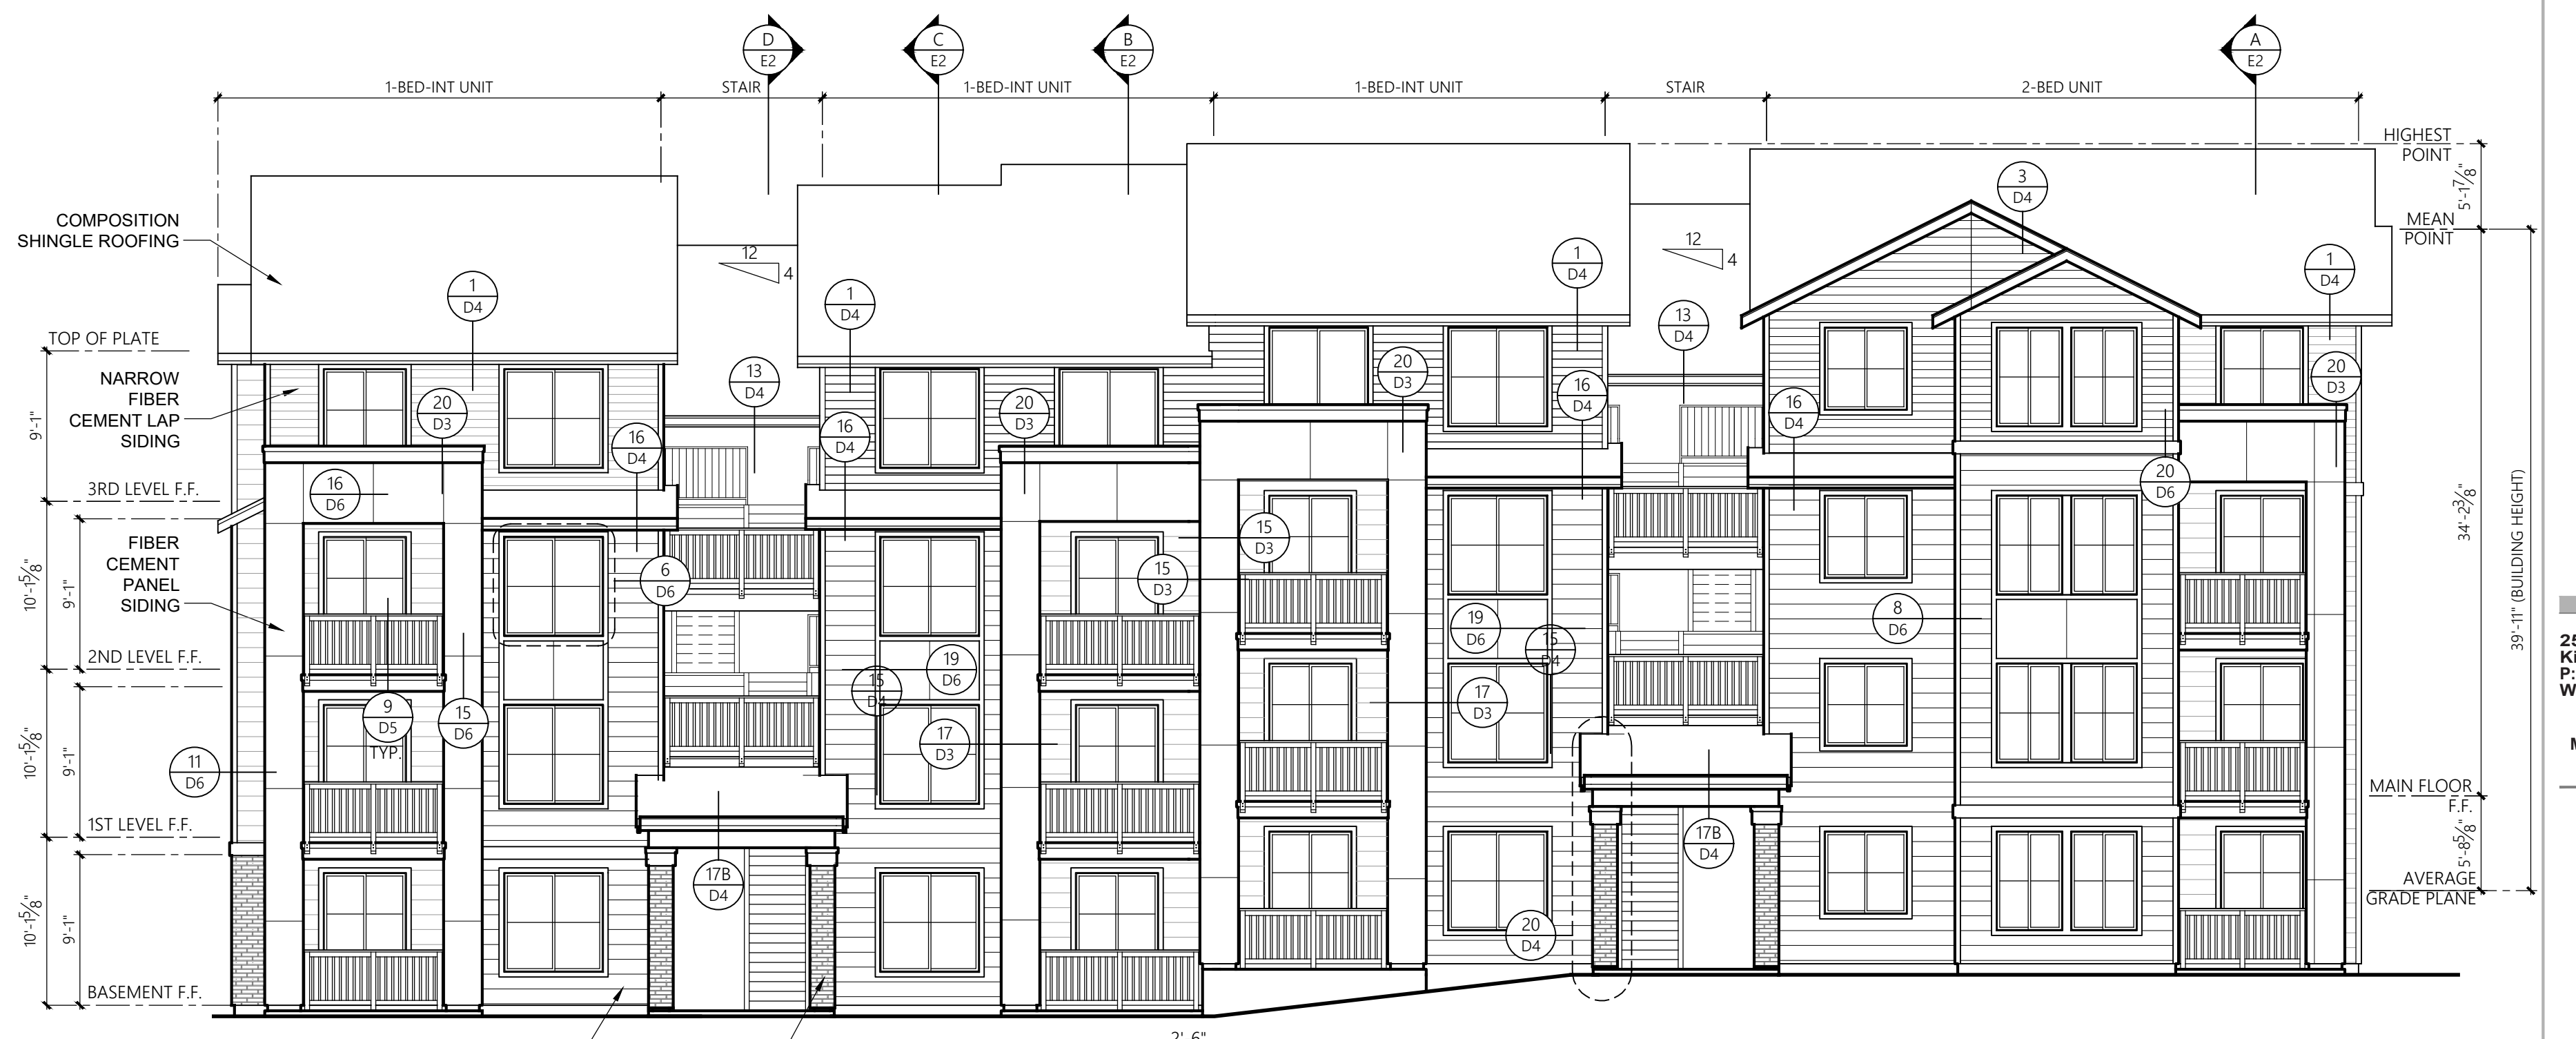


BUILDING A FRONT ELEVATION
1/8" = 1'-0"

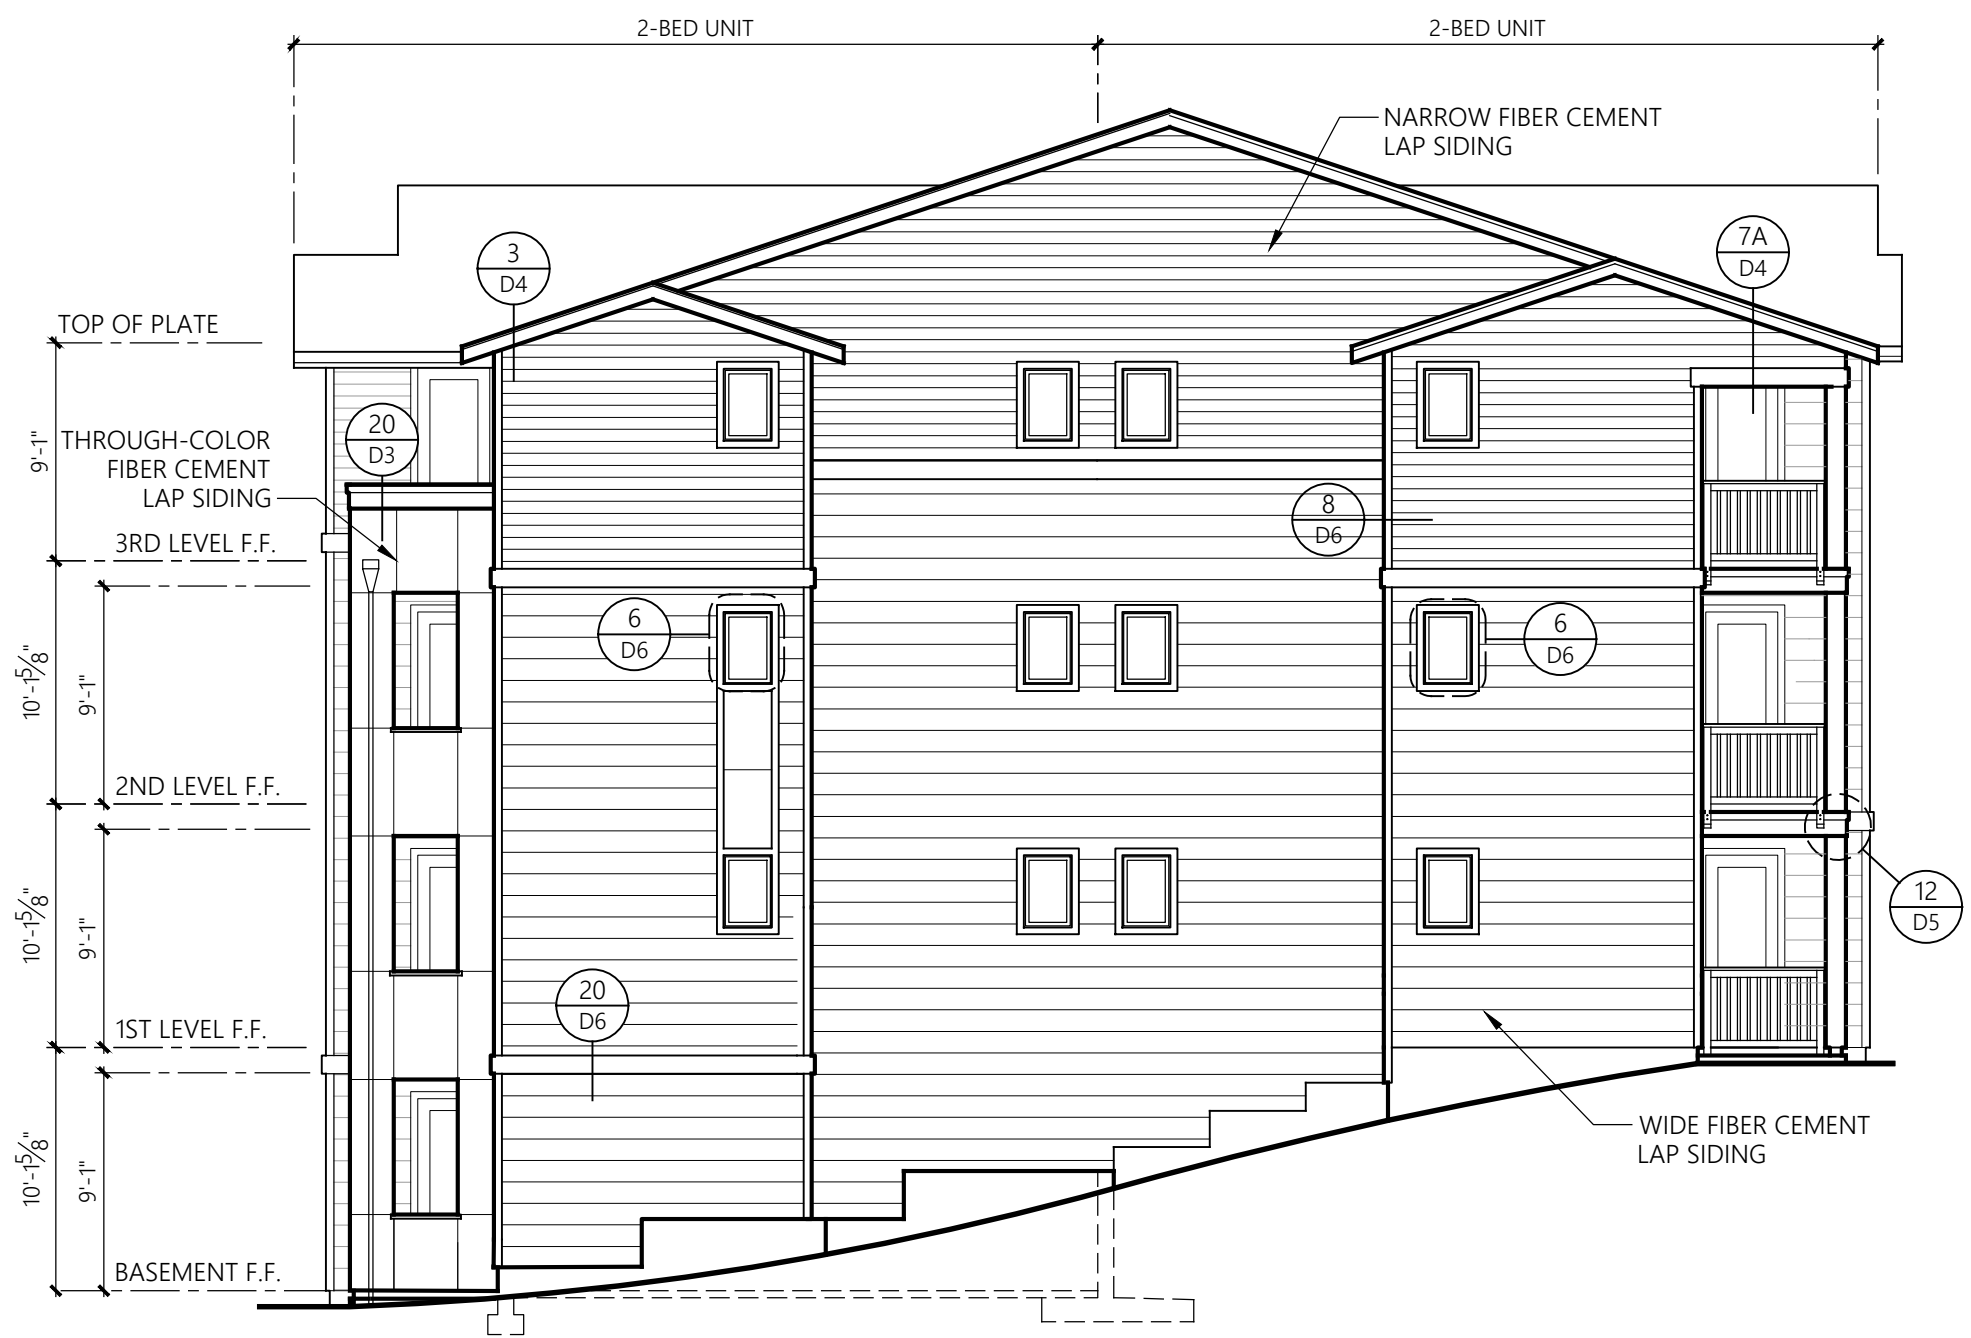


BUILDING A SIDE ELEVATION
1/8" = 1'-0"

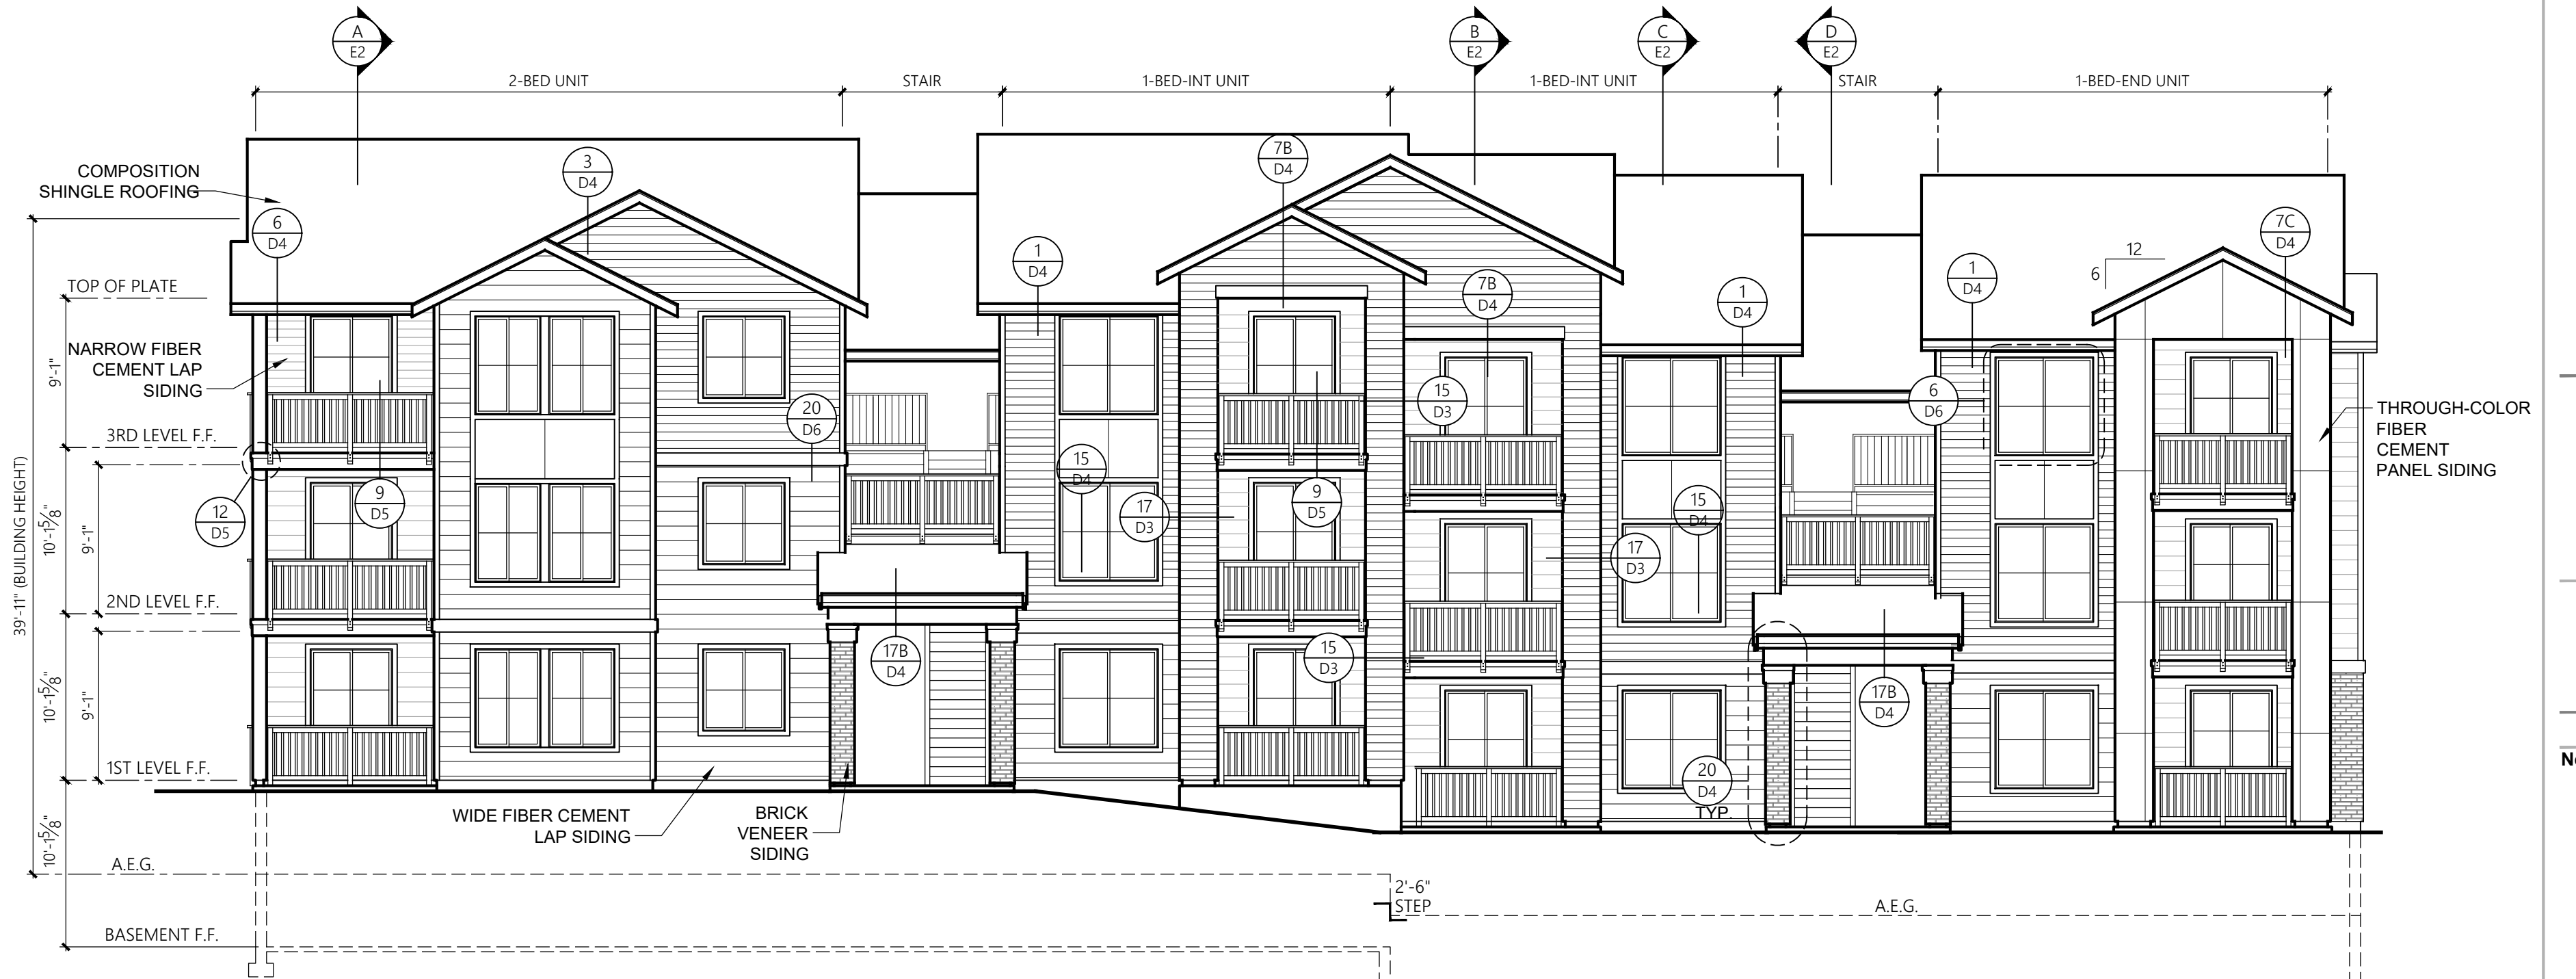


BUILDING A REAR ELEVATION
1/8" = 1'-0"
ELEVATION SCHEME 1

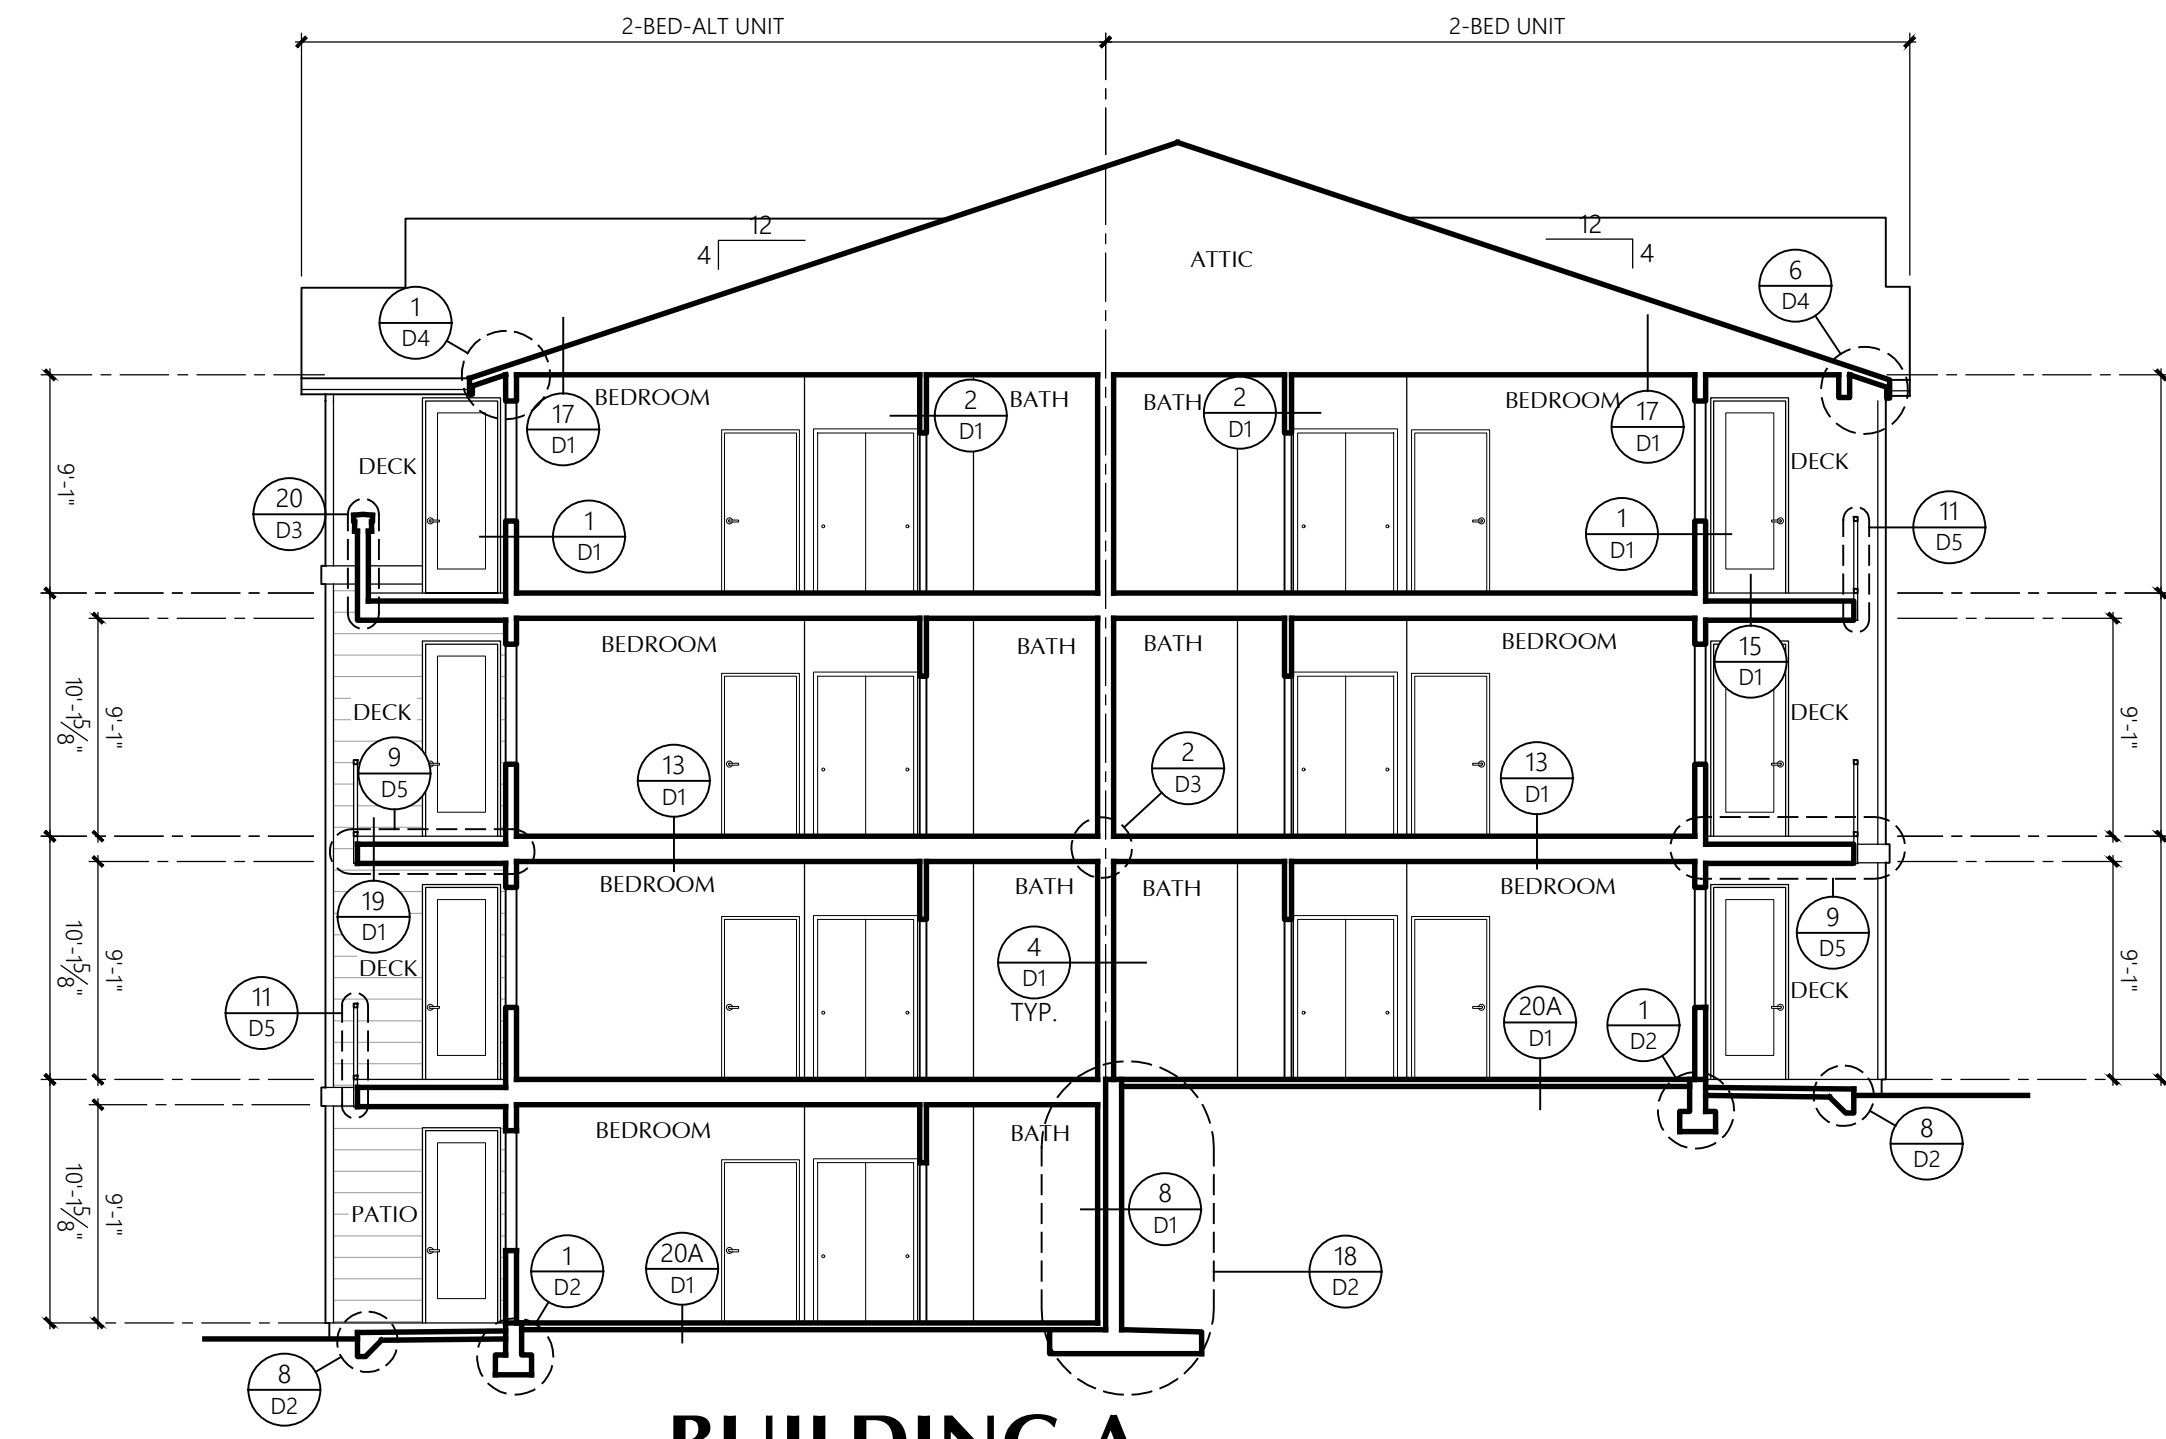


BUILDING A SECTION A
1/8" = 1'-0"

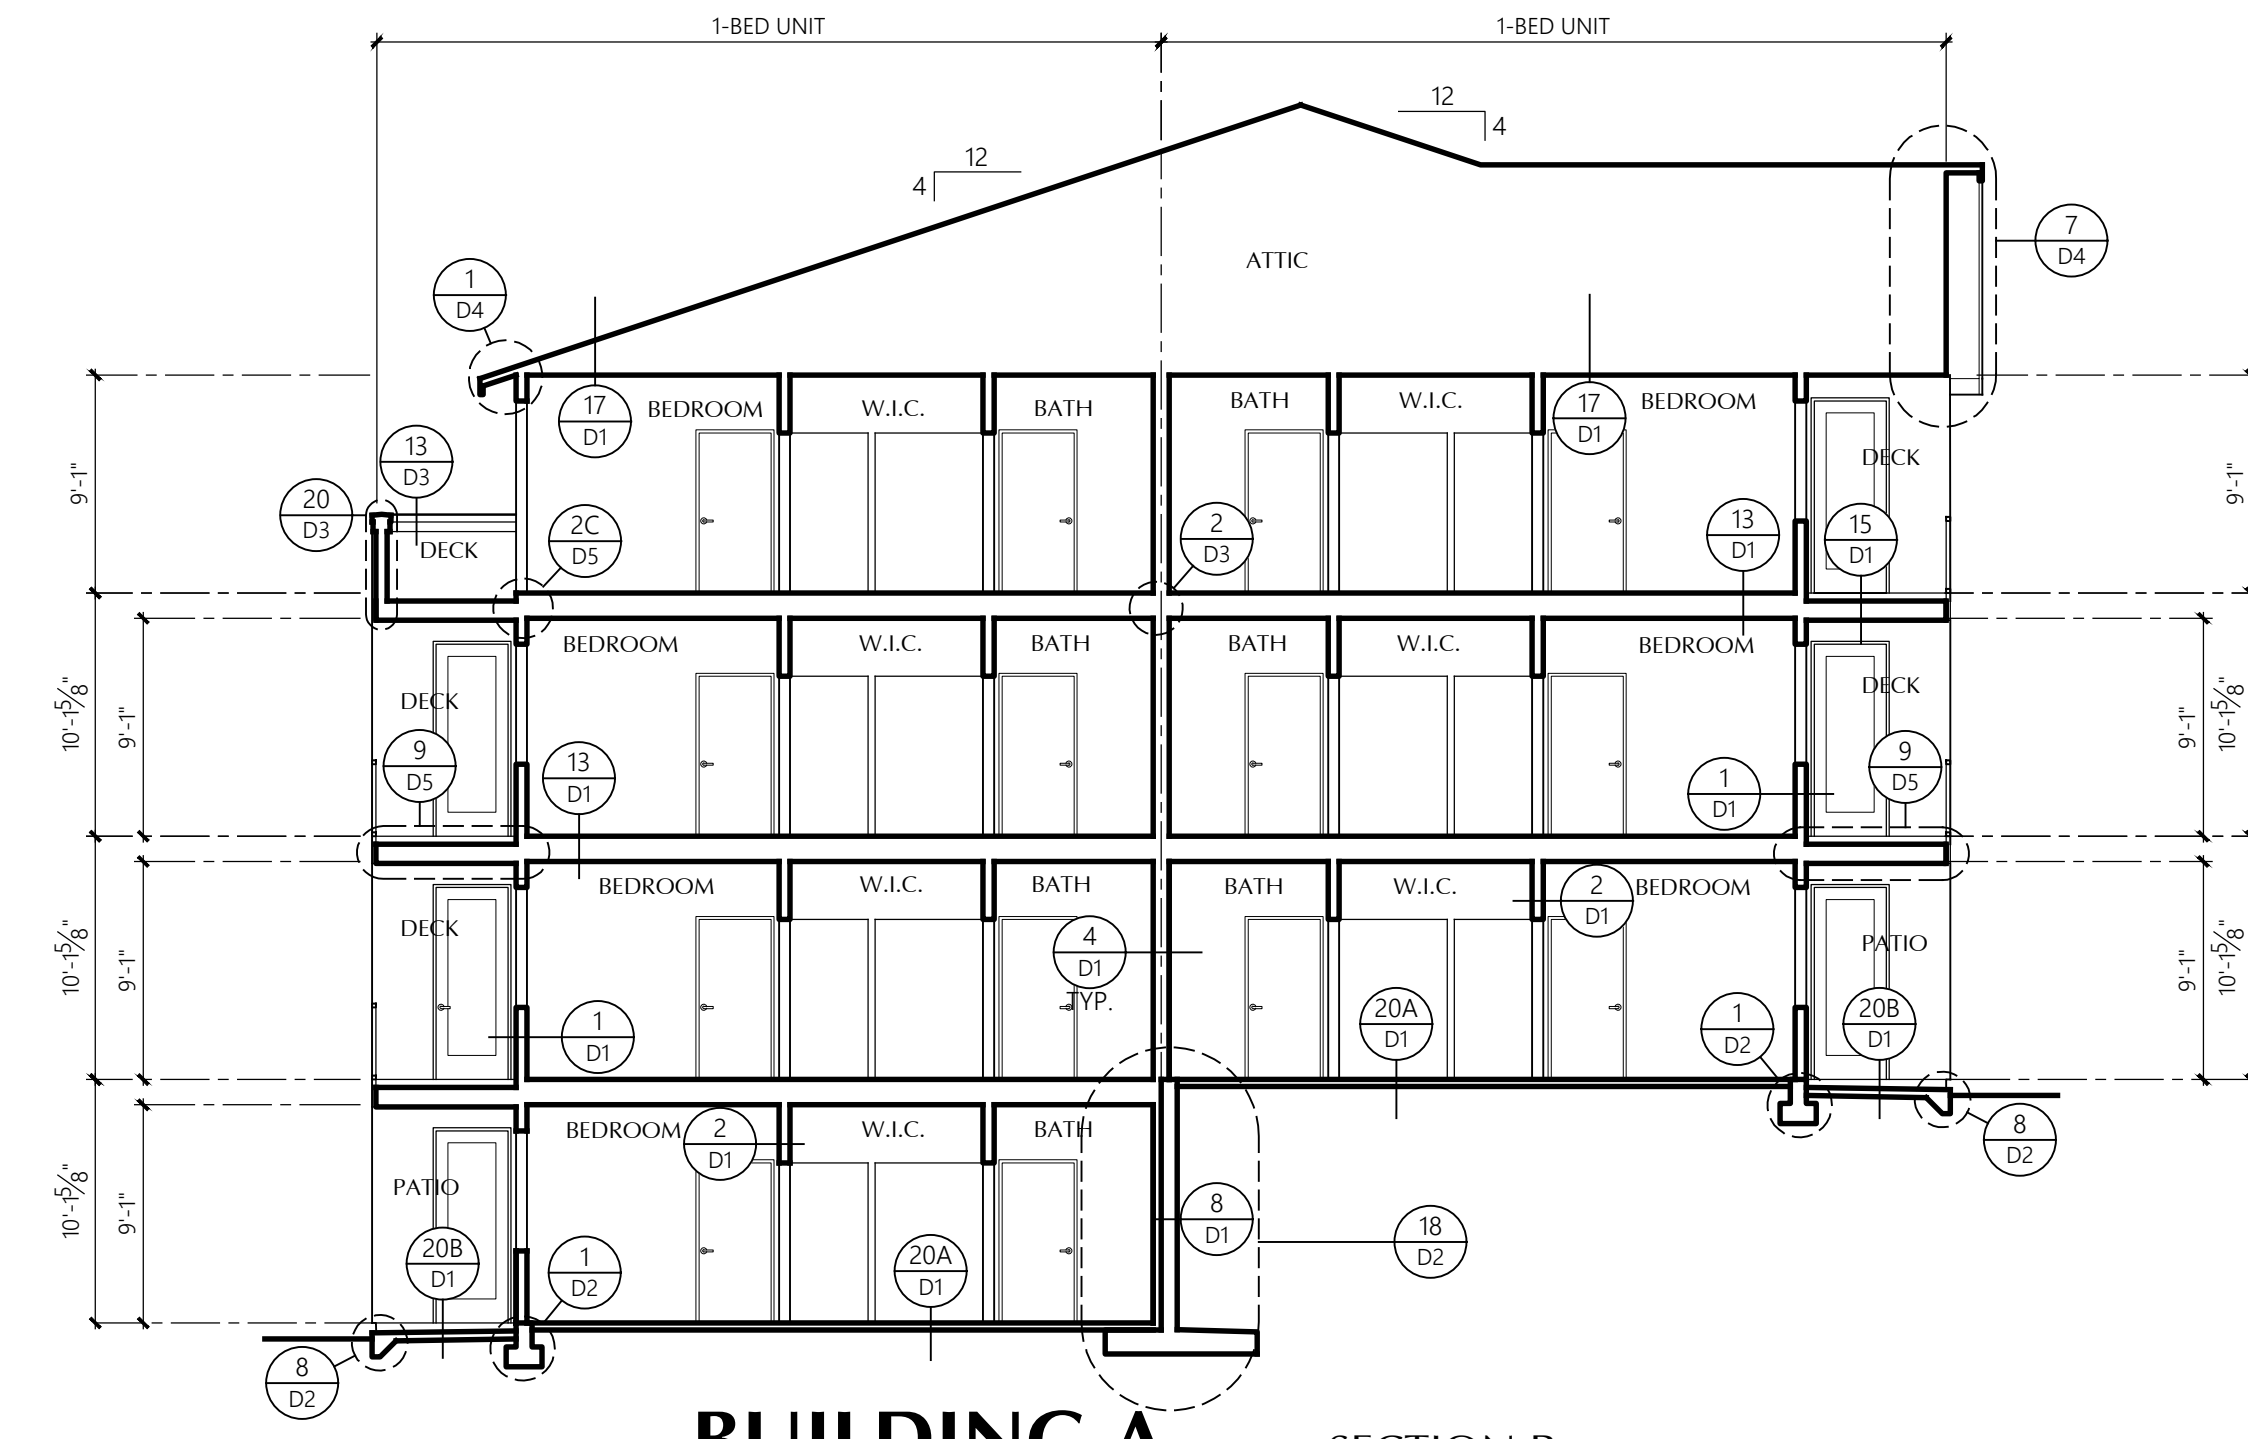

BUILDING A SECTION B
1/8" = 1'-0"

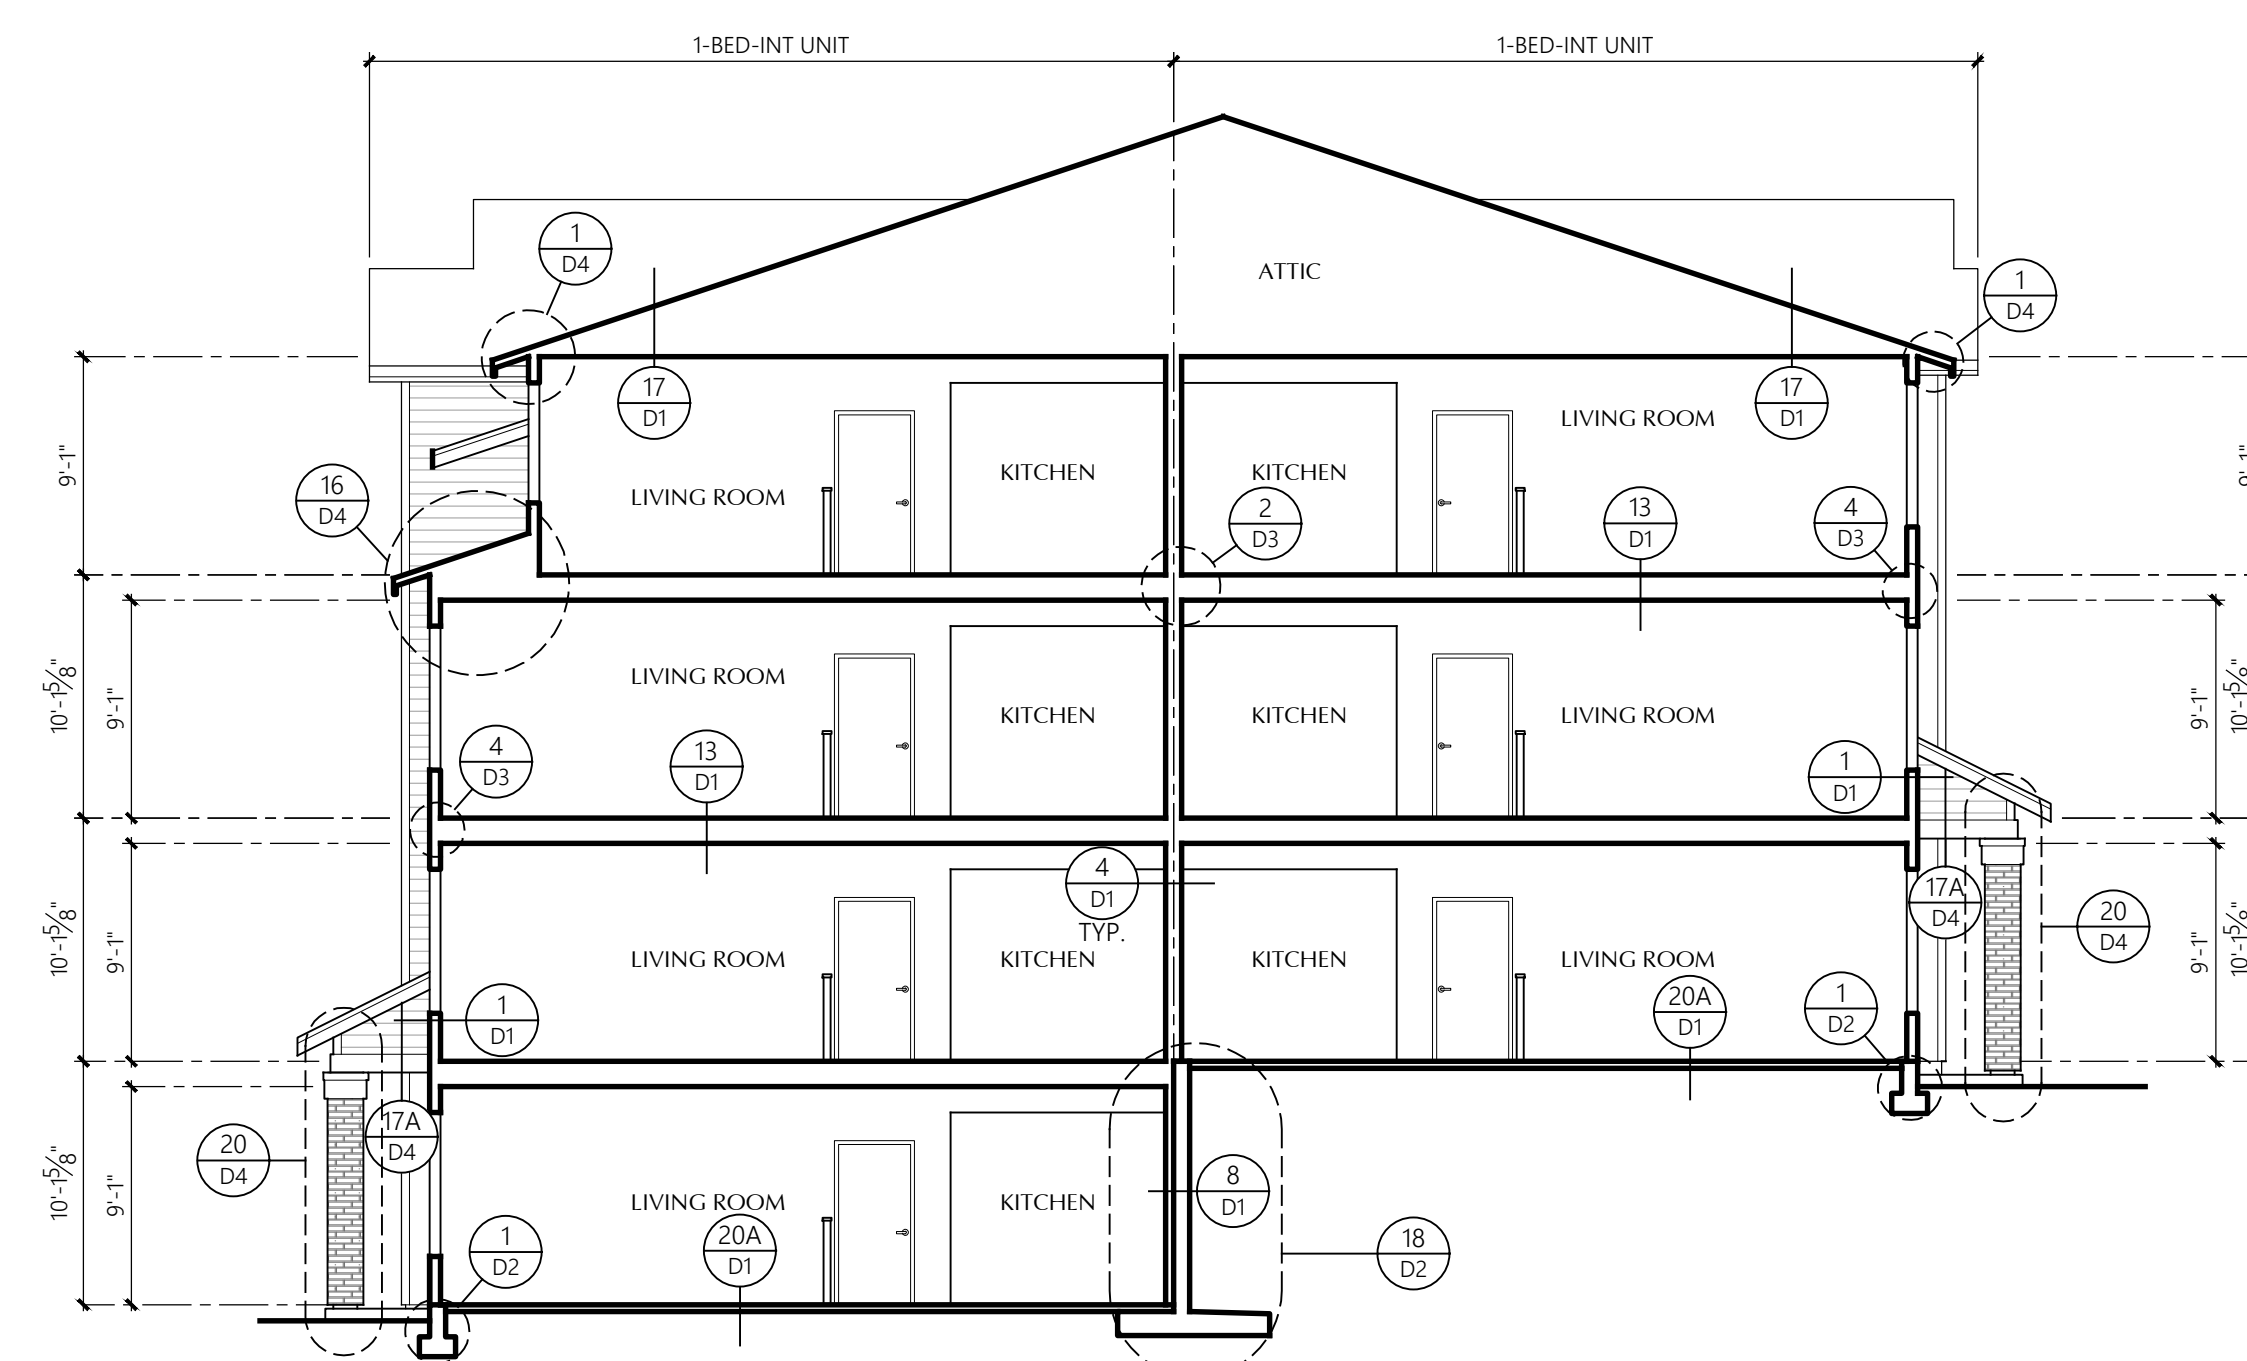

BUILDING A SECTION C
1/8" = 1'-0"

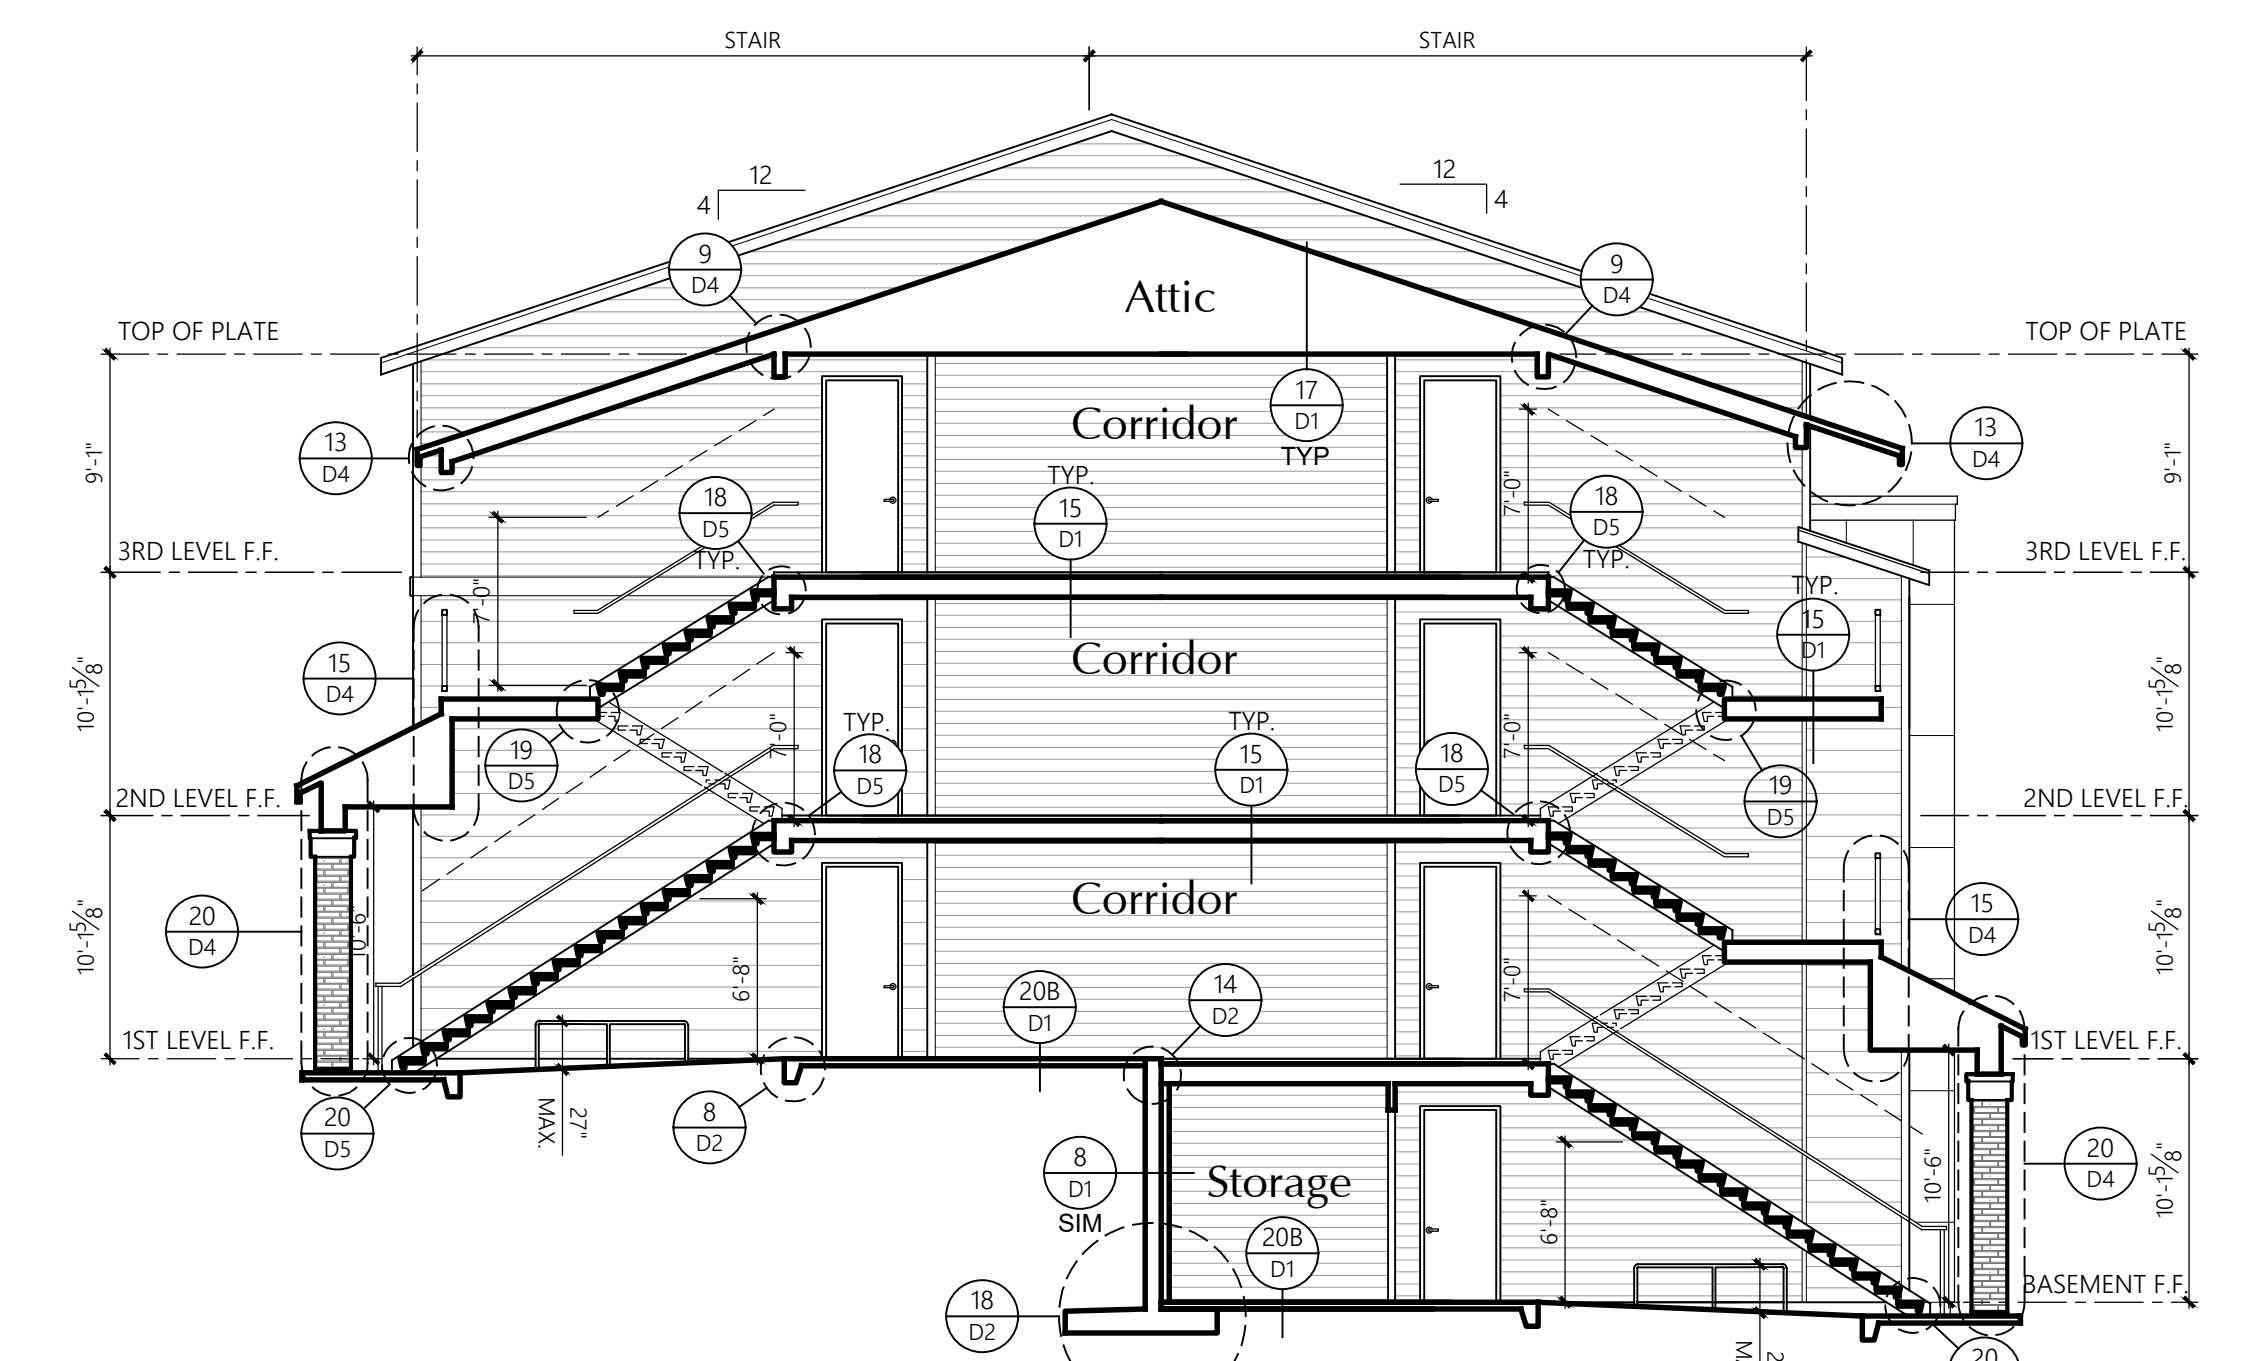

BUILDING A SECTION D
1/8" = 1'-0"

WINDOW HEADER
HEIGHT 8' A.F.F.

STRUCTURAL NOTES-TABLES

Special Inspection required per Chapter 17 of the 2018 IBC - SUBMIT REPORTS TO INSPECTORS WITH THE CITY OF PUYALLUP

WIND PRESSURE TABLE FOR COMPONENTS & CLADDING (ASD)						
ROOF SURFACES ¹						
EFFECTIVE WIND AREA	POSITIVE PRESSURE (PSF)			NEGATIVE PRESSURE (PSF)		
	ZONE ²					
	1	2	3	1	2	3
10 SF	7.80	7.80	7.80	-12.39	-21.56	-31.89
20 SF	7.04	7.04	7.04	-12.01	-19.65	-29.59
50 SF	6.27	6.27	6.27	-11.62	-17.74	-27.30
100 SF	5.51	5.51	5.51	-11.24	-15.83	-25.01
500 SF	5.51	5.51	5.51	-11.24	-15.83	-25.01
WALL SURFACES						
EFFECTIVE WIND AREA	POSITIVE PRESSURE (PSF)			NEGATIVE PRESSURE (PSF)		
	ZONE ²					
	4	5	4	5	4	5
10 SF	12.18	12.18	-13.21	-16.31		
20 SF	11.56	11.56	-12.59	-15.07		
50 SF	10.94	10.94	-11.98	-13.83		
100 SF	10.32	10.32	-11.36	-12.57		
500 SF	9.08	9.08	-10.12	-10.12		

1. NET WIND PRESSURES AT ROOF SURFACES = VALUE FROM TABLE ABOVE +2/3 DEAD LOAD (DEAD LOAD REDUCES NEGATIVE PRESSURE + ADDS TO POSITIVE PRESSURES)
2. ZONES ARE DEFINED BY FIGURE 30.6-1 ASCE/SEI 07-10 FOR ROOF AND WALL ELEMENTS

2018 International Building Code - Statement of Special Inspection

MATERIAL/ TYPE INSPECTION	IBC CODE REFERENCE	REFERENCE STANDARD	FREQUENCY APPLICABLE TO THIS PROJECT			SCOPE OF SERVICE
			CONT.	PERIODIC	REQUIRED	
Site Preparation	Table 1705.6 Item 5	-	-	X	N/A	Inspection to determine that the site has been prepared in accordance with the approved soils or geotechnical report.
Prepared Fill - During Fill Preparation	Table 1705.6 Item 4	-	X	-	YES	Inspection to determine that the materials being used and maximum lift thicknesses comply with the approved report as specified in Section 1804.2.
Evaluation of in-place Density	Table 1705.6 Item 3	-	-	X	YES	Tests to determine, at the approved frequency, that the in-place dry density of the compacted fill complies with the approved report.
Footings and Foundations	1805.1 - 1805.9 Table 1705.6 Item 1	-	-	X	YES	Confirm soils suitable for the design allowable soil bearing pressure are present at bearing grade. Confirm the footing dimensions are as specified on the project plans.
Foundation Depth	Table 1705.6 Item 2	-	-	X	YES	Confirm excavation are extended to proper depth and have reached proper materials.

2018 International Building Code - Statement of Special Inspection

MATERIAL/ TYPE INSPECTION	IBC CODE REFERENCE	REFERENCE STANDARD	FREQUENCY APPLICABLE TO THIS PROJECT			SCOPE OF SERVICE
			CONT.	PERIODIC	REQUIRED	
Materials	1705.3.1, Table 1705.3 Item 1	Applicable ASTM material spec.; AISC 360, Section A3.3	-	X	YES	Manufacturer's Certificates of Compliance or Tests per Chapter 3 of ACI 318, per ASTM A 706, and per 1705.3.1
Installation of Reinforcing Steel	1910.4 Table 1705.3 Item 1	ACI 318.3.5; 7.1 - 7.7	-	X	YES	Inspection to confirm compliance with details shown on approved Construction Documents, Shop Drawings, ACI 318 and Code Section 1910.4
Welding of Reinforcing Steel	Table 1705.3 Item 2	AWS D1.4, ACI 318.3.5.2	-	-	N/A	Observation of reinforcing steel welding in accordance with Table 1705.2.2, Item 2, (see attached steel construction table).
Bolt Installation	1908.5, 1901.1 Table 1705.3 Item 3	ACI 318: 8.1.3, 21.2.8	X	-	YES	Observation of anchor bolts to be installed in concrete prior to and during placement of concrete where allowable loads have been increased.
Formwork	Table 1705.3 Item 12	ACI 318.6.1.1	-	X	YES	Inspection for compliance with ACI 318, Section 6.1, 6.2, for shape, location and dimensions of concrete member being formed.
Concrete Strength	1910.10, Table 1705.3 Item 6	ASTM C 172, ASTM C 31, ACI 318.5.6, 5.8	-	X	NO	Evaluation of Concrete strength in accordance with ACI 318, Section 5.6 and in accordance with the requirements of IBC 1905.6.
Concrete Mixes	1904.2, 1910.2, 1910.3 Table 1705.3 Item 5	ACI 318: 4, 5.2-5.4	-	X	YES	Inspection for use of proper mix proportions and techniques, ACI 318, Chapter 4, Sections 5.2 - 5.4.
Concrete Sampling	1910.10 Table 1705.3 Item 6	ASTM C 172, ASTM C 31, ACI 318.5.6, 5.8	X	-	NO	
Concrete Placement	1910.6, 1910.7, 1910.8, Table 1705.3 Item 7	ACI 318.5.9, 5.10	X	-	YES	Inspection for proper application techniques; ACI 318, Sections 5.9 and 5.10
Curing Temperatures and Techniques	1910.9 Table 1705.3 Item 8	ACI 318: 5.11-5.13	-	X	NO	Inspection for maintenance of curing temperatures and techniques; ACI 318, Sections 5.11, 5.12 and 5.13.
Prestressed Concrete: Application Prestressing Forces	Table 1705.3 Item 9a	ACI 318: 18.20, ACI 18.18.4	X	-	NO	Field inspections of precast concrete members in accordance with ACI 318, Section 18.20.
Prestressed Concrete: Grouting of unbonded prestressing tendons in seismic-force-resisting system	Table 1705.3 Item 9b	ACI 318: 18.20, ACI 18.18.4	X	-	NO	Field inspections of precast concrete members in accordance with ACI 318, Chapter 18.18.4.
Manufacture of Precast Concrete	1704.2.1	-	-	X	NO	Certificate from Independent Agency and current agreement for periodic (minimum 6 month intervals) in-plant quality assurance inspections.
Erection of Precast Concrete	Table 1705.3 Item 10	ACI 318: 16	-	X	NO	Field inspections of precast concrete members in accordance with ACI 318, Chapter 16.
Post Tensioning	Table 1705.3 Item 11	ACI 318: 6.2	-	X	NO	Verification of in-situ concrete strength, prior to stressing of tendons in post-tensioned concrete and prior to removal of shores and forms for beams and structural slabs in accordance with ACI 318, Section, 6.2.
Post Installed Anchors	1909.1, Table 1705.3 Item 11	ACI 318: 3.8.6, 8.1.3, 21.1.8	-	X	YES	Verification of anchors post installed in hardened concrete members.

2018 International Building Code - Statement of Special Inspection

MATERIAL/ TYPE INSPECTION	IBC CODE REFERENCE	REFERENCE STANDARD	FREQUENCY APPLICABLE TO THIS PROJECT			SCOPE OF SERVICE
			CONT.	PERIODIC	REQUIRED	
Fabrication - Inspection of Fabricator's Quality Control Procedures	1704.2.5	-	-	X	YES	Certificate from Independent Agency and current agreement for periodic (minimum 6 month intervals) in-plant quality assurance inspections.

2018 International Building Code - Statement of Special Inspection

MATERIAL/ TYPE INSPECTION	IBC CODE REFERENCE	REFERENCE STANDARD	FREQUENCY APPLICABLE TO THIS PROJECT			SCOPE OF SERVICE
			CONT.	PERIODIC	REQUIRED	
Structural Steel	1705.11.1	AISC 341	X	-	N/A	Observation of structural welding in accordance with AISC Seismic. Not required for 5/16" single pass fillet welds or welding of metal deck.
Structural Wood: Inspection of field gluing operations of elements of the seismic force resisting system.	1705.11.2	-	X	-	N/A	Inspection of field gluing operations of elements of the seismic force resisting system.
Structural Wood: Inspection of nailing, bolting, anchoring and other fastening components within the seismic force resisting system, including drag struts, braces and hold-downs.	1705.11.2	-	-	X	YES	Inspection of nailing, bolting, anchoring and other fastening components within the seismic force resisting system, including drag struts, braces and hold-downs. Not required for nailing o.c., spacing greater than 4" o.c.
Cold-formed Steel Framing	1705.11.3	-	-	X	NO	Inspection of welding operations of elements of the seismic force resisting system.
Cold-formed Steel Framing	1705.11.3	-	-	X	NO	Inspection of screw attachments, bolting, anchoring and other fastening components within the seismic force resisting system, including struts, braces and hold-downs.

2018 International Building Code - Statement of Special Inspection

MATERIAL/ TYPE INSPECTION	IBC CODE REFERENCE	REFERENCE STANDARD	FREQUENCY APPLICABLE TO THIS PROJECT			SCOPE OF SERVICE
			CONT.	PERIODIC	REQUIRED	
Structural Observations	1704.5	-	-	X	If required by jurisdiction	Structural observations to be performed to observe general conformance to the construction documents.


Revisions to this sheet:

Bradley Heights Apartments
202 27th Ave SE
Puyallup, Washington

PROJECT NO. : 23-007
DESIGNED BY : TLC, OGG, MRO
DRAWN BY : RSO
ISSUE DATE : 2-20-24
LATEST REV. OF DWG. SET :


SUBMITTAL SET ONLY NOT FOR CONSTRUCTION
THESE DRAWINGS ARE SUBJECT TO REVISIONS PENDING LOCAL JURISDICTIONAL REVIEW.

S1.1

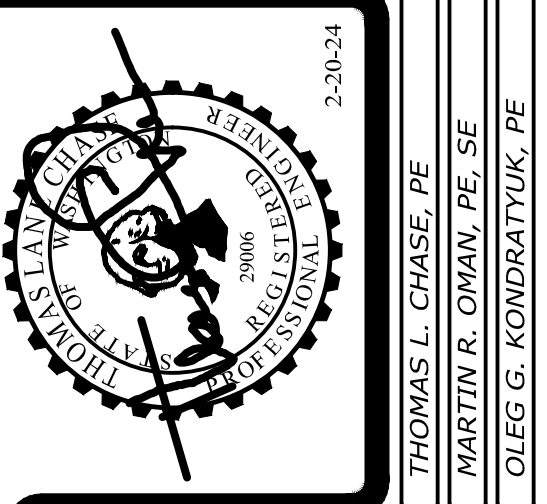


Puyallup, Washington 98374
Ph. 253-314-9822
www.solutions4structures.com


Solutions 4 Structures
A Structural Engineering Corporation

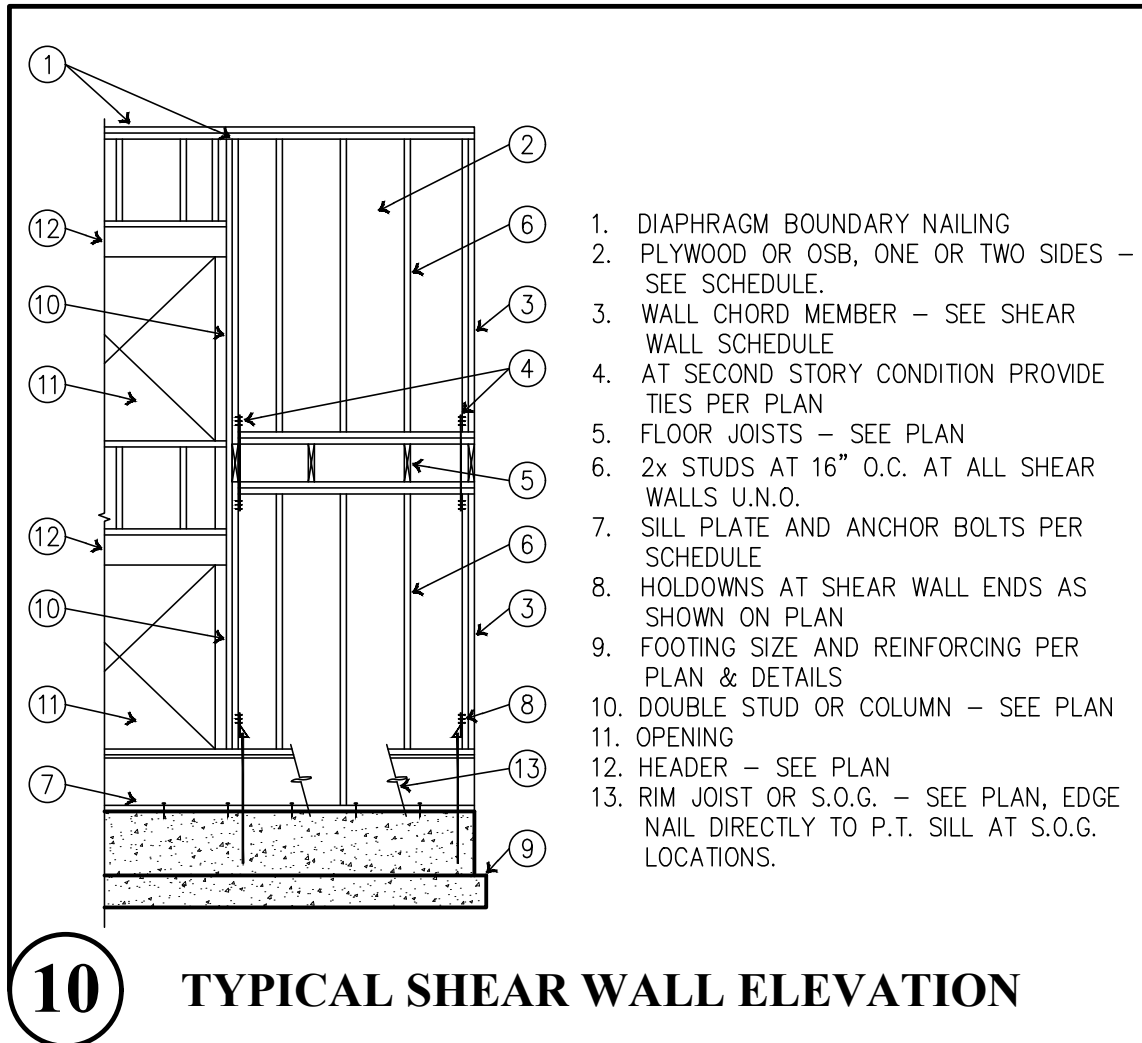


10 TYPICAL SHEAR WALL ELEVATION

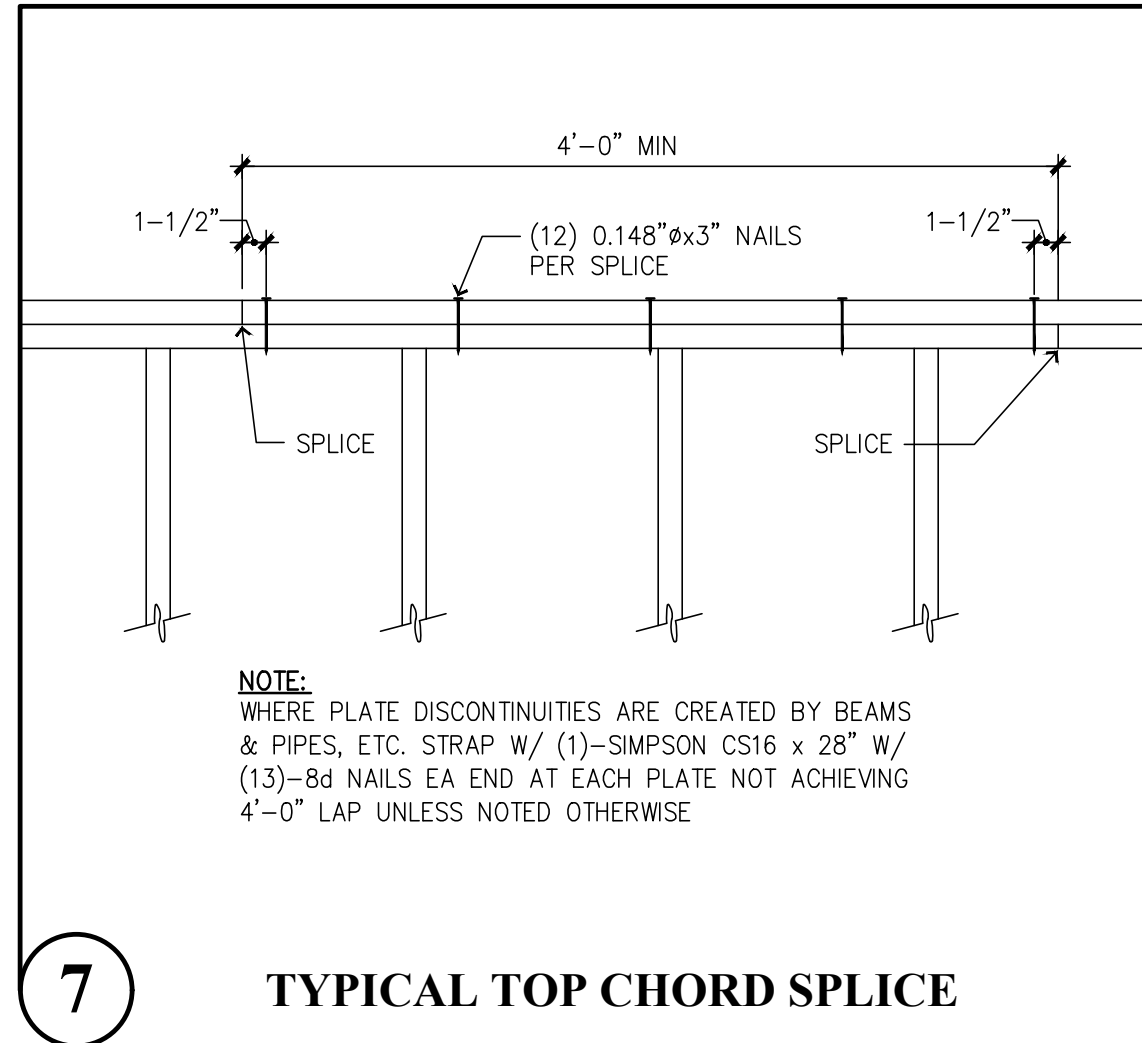

7 TYPICAL TOP CHORD SPLICE

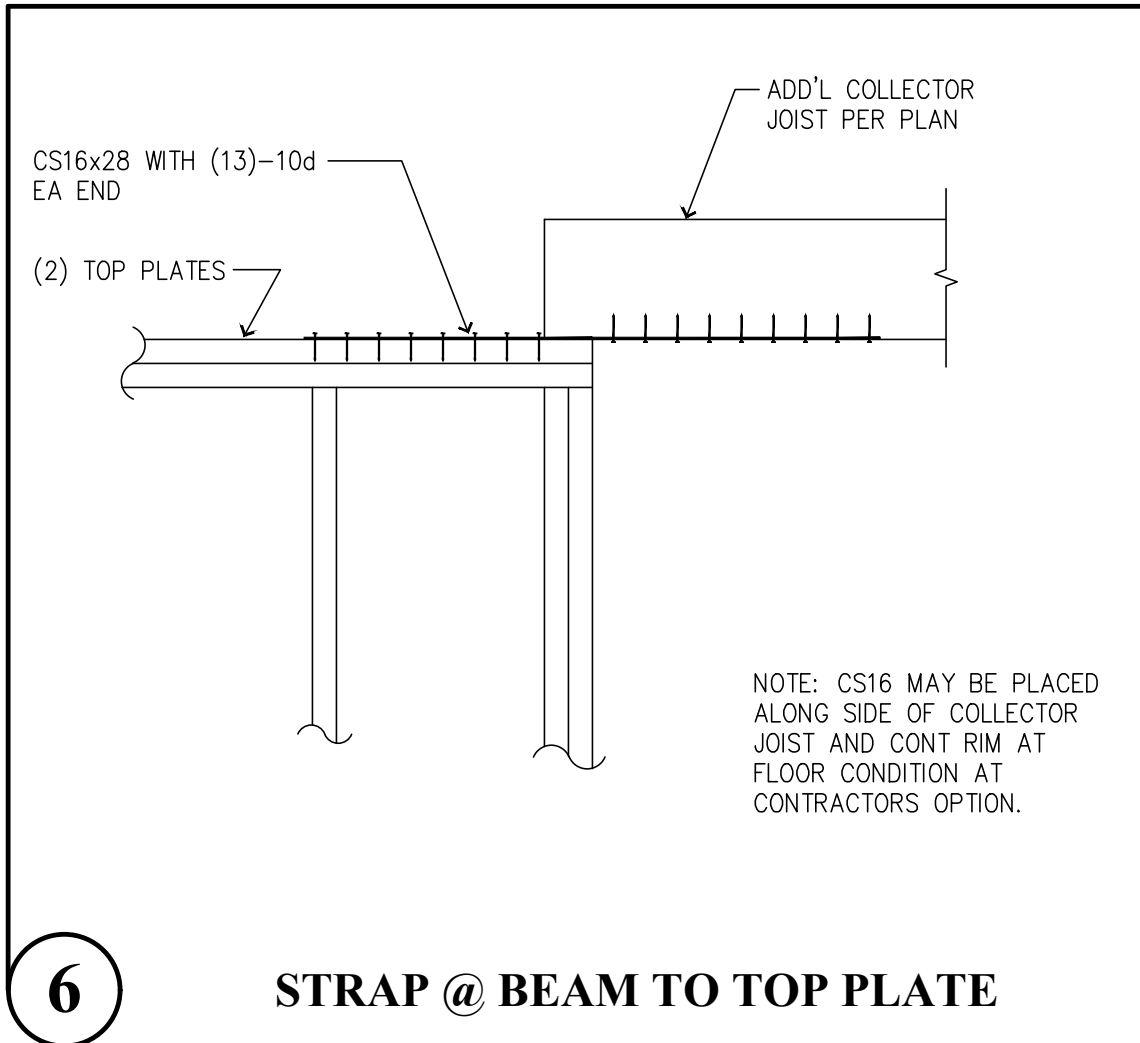


6 STRAP @ BEAM TO TOP PLATE

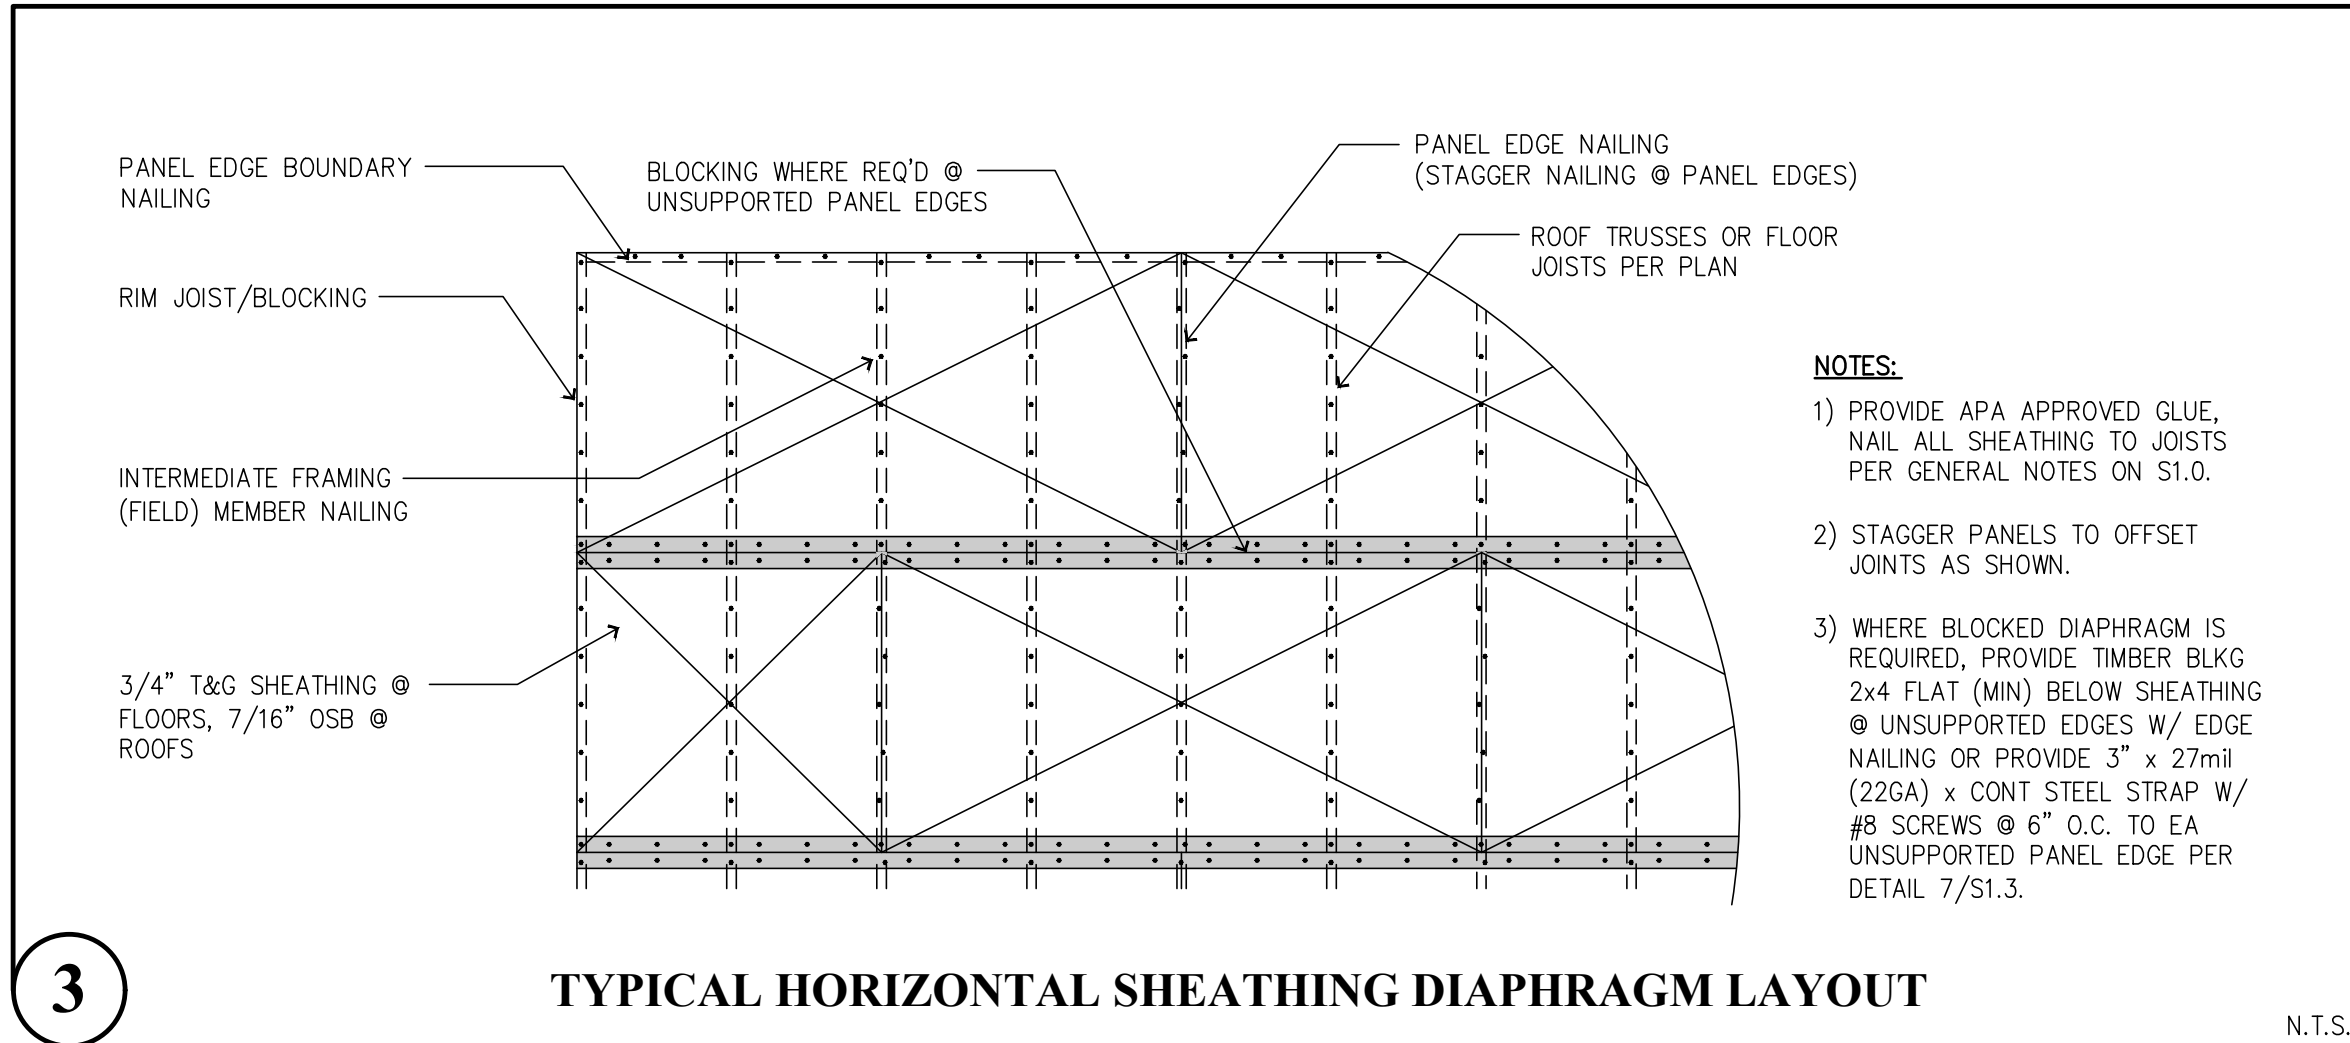


3 TYPICAL HORIZONTAL SHEATHING DIAPHRAGM LAYOUT

- NOTES:**
- 1) PROVIDE APA APPROVED GLUE, NAIL ALL SHEATHING TO JOISTS PER GENERAL NOTES ON S1.0.
 - 2) STAGGER PANELS TO OFFSET JOINTS AS SHOWN.
 - 3) WHERE BLOCKED DIAPHRAGM IS REQUIRED, PROVIDE TIMBER BLKG 2x4 FLAT (MIN) BELOW SHEATHING @ UNSUPPORTED EDGES W/ EDGE NAILING OR PROVIDE 3\"/>


N.T.S.

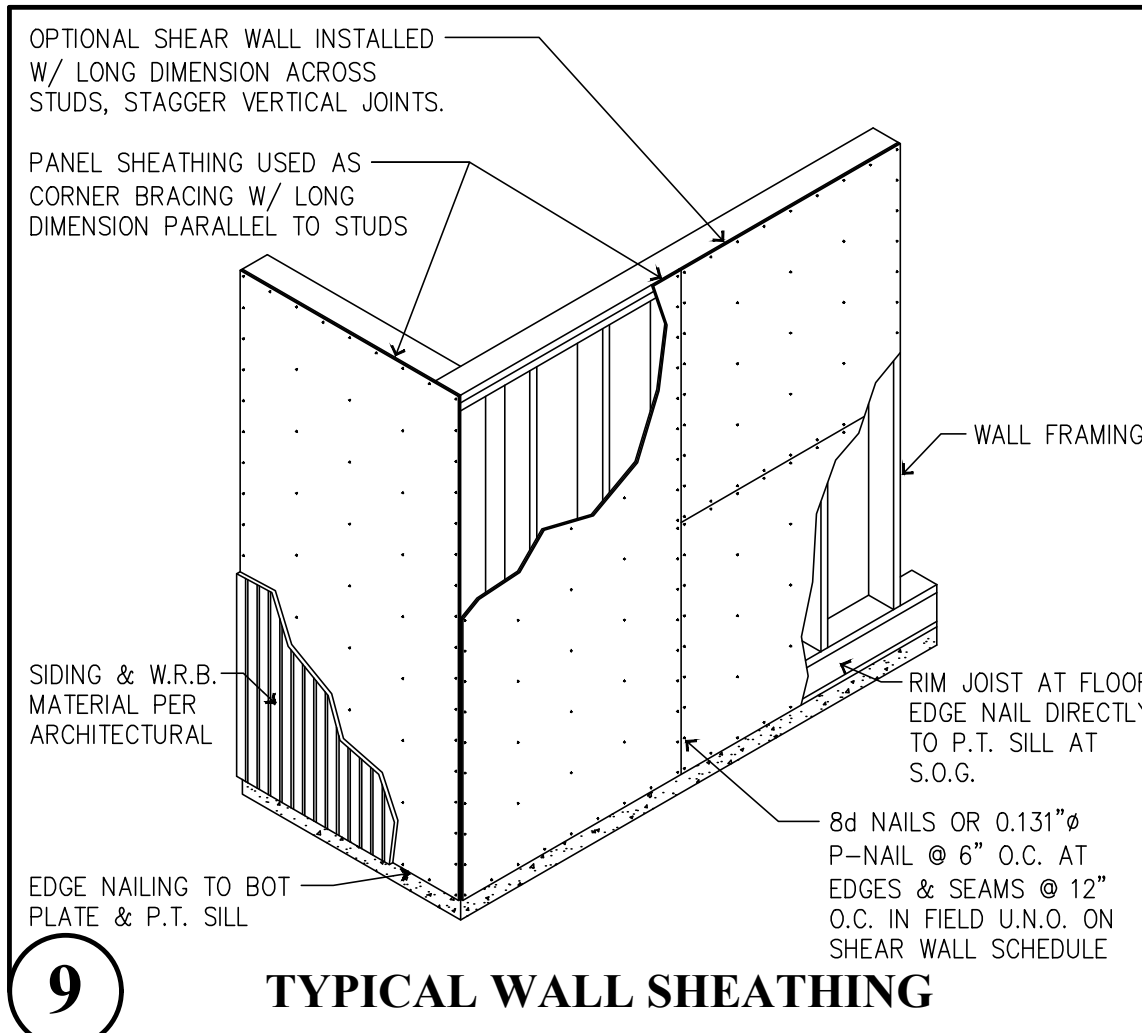


9 TYPICAL WALL SHEATHING

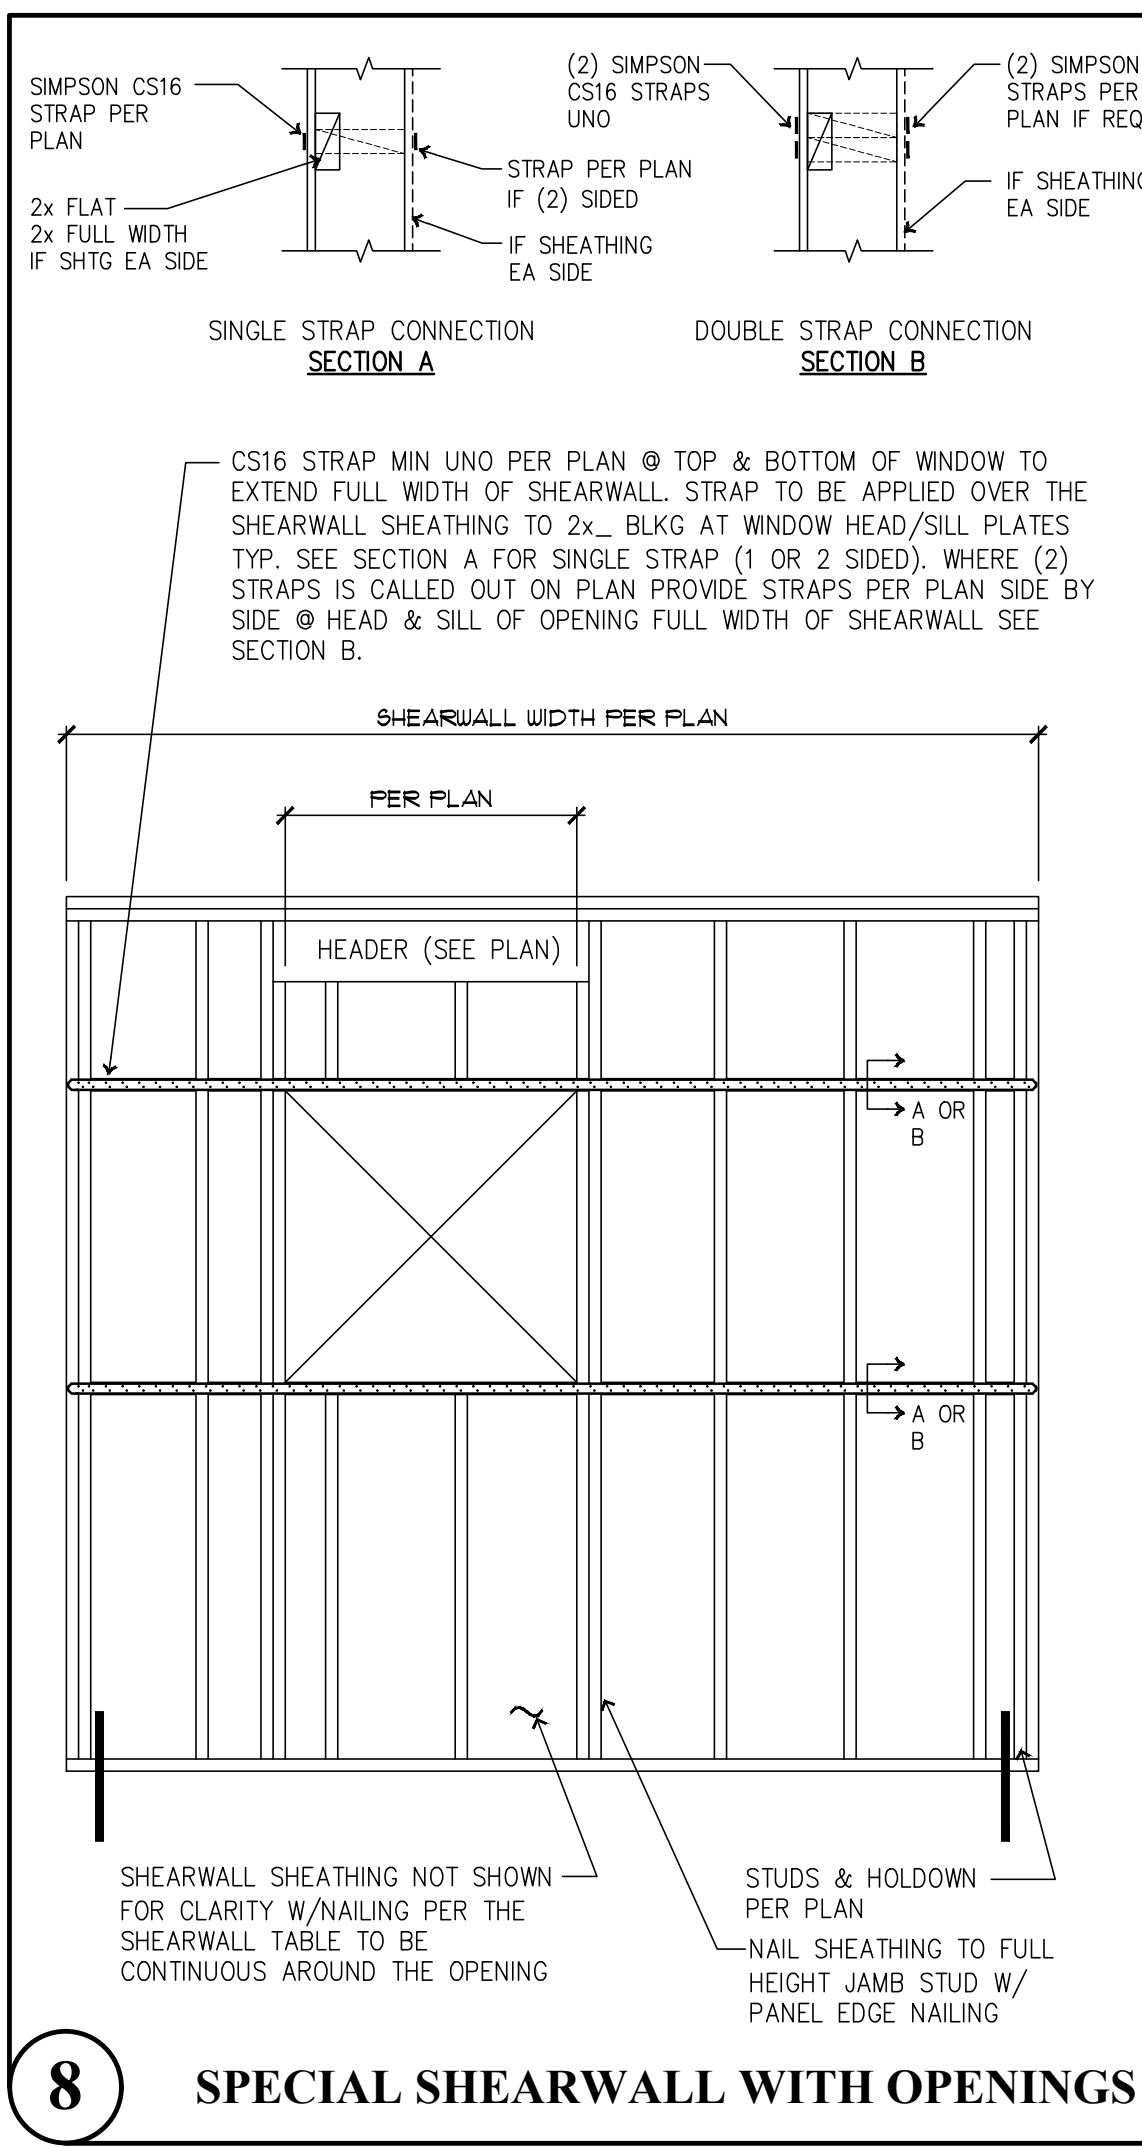

8 SPECIAL SHEAR WALL WITH OPENINGS

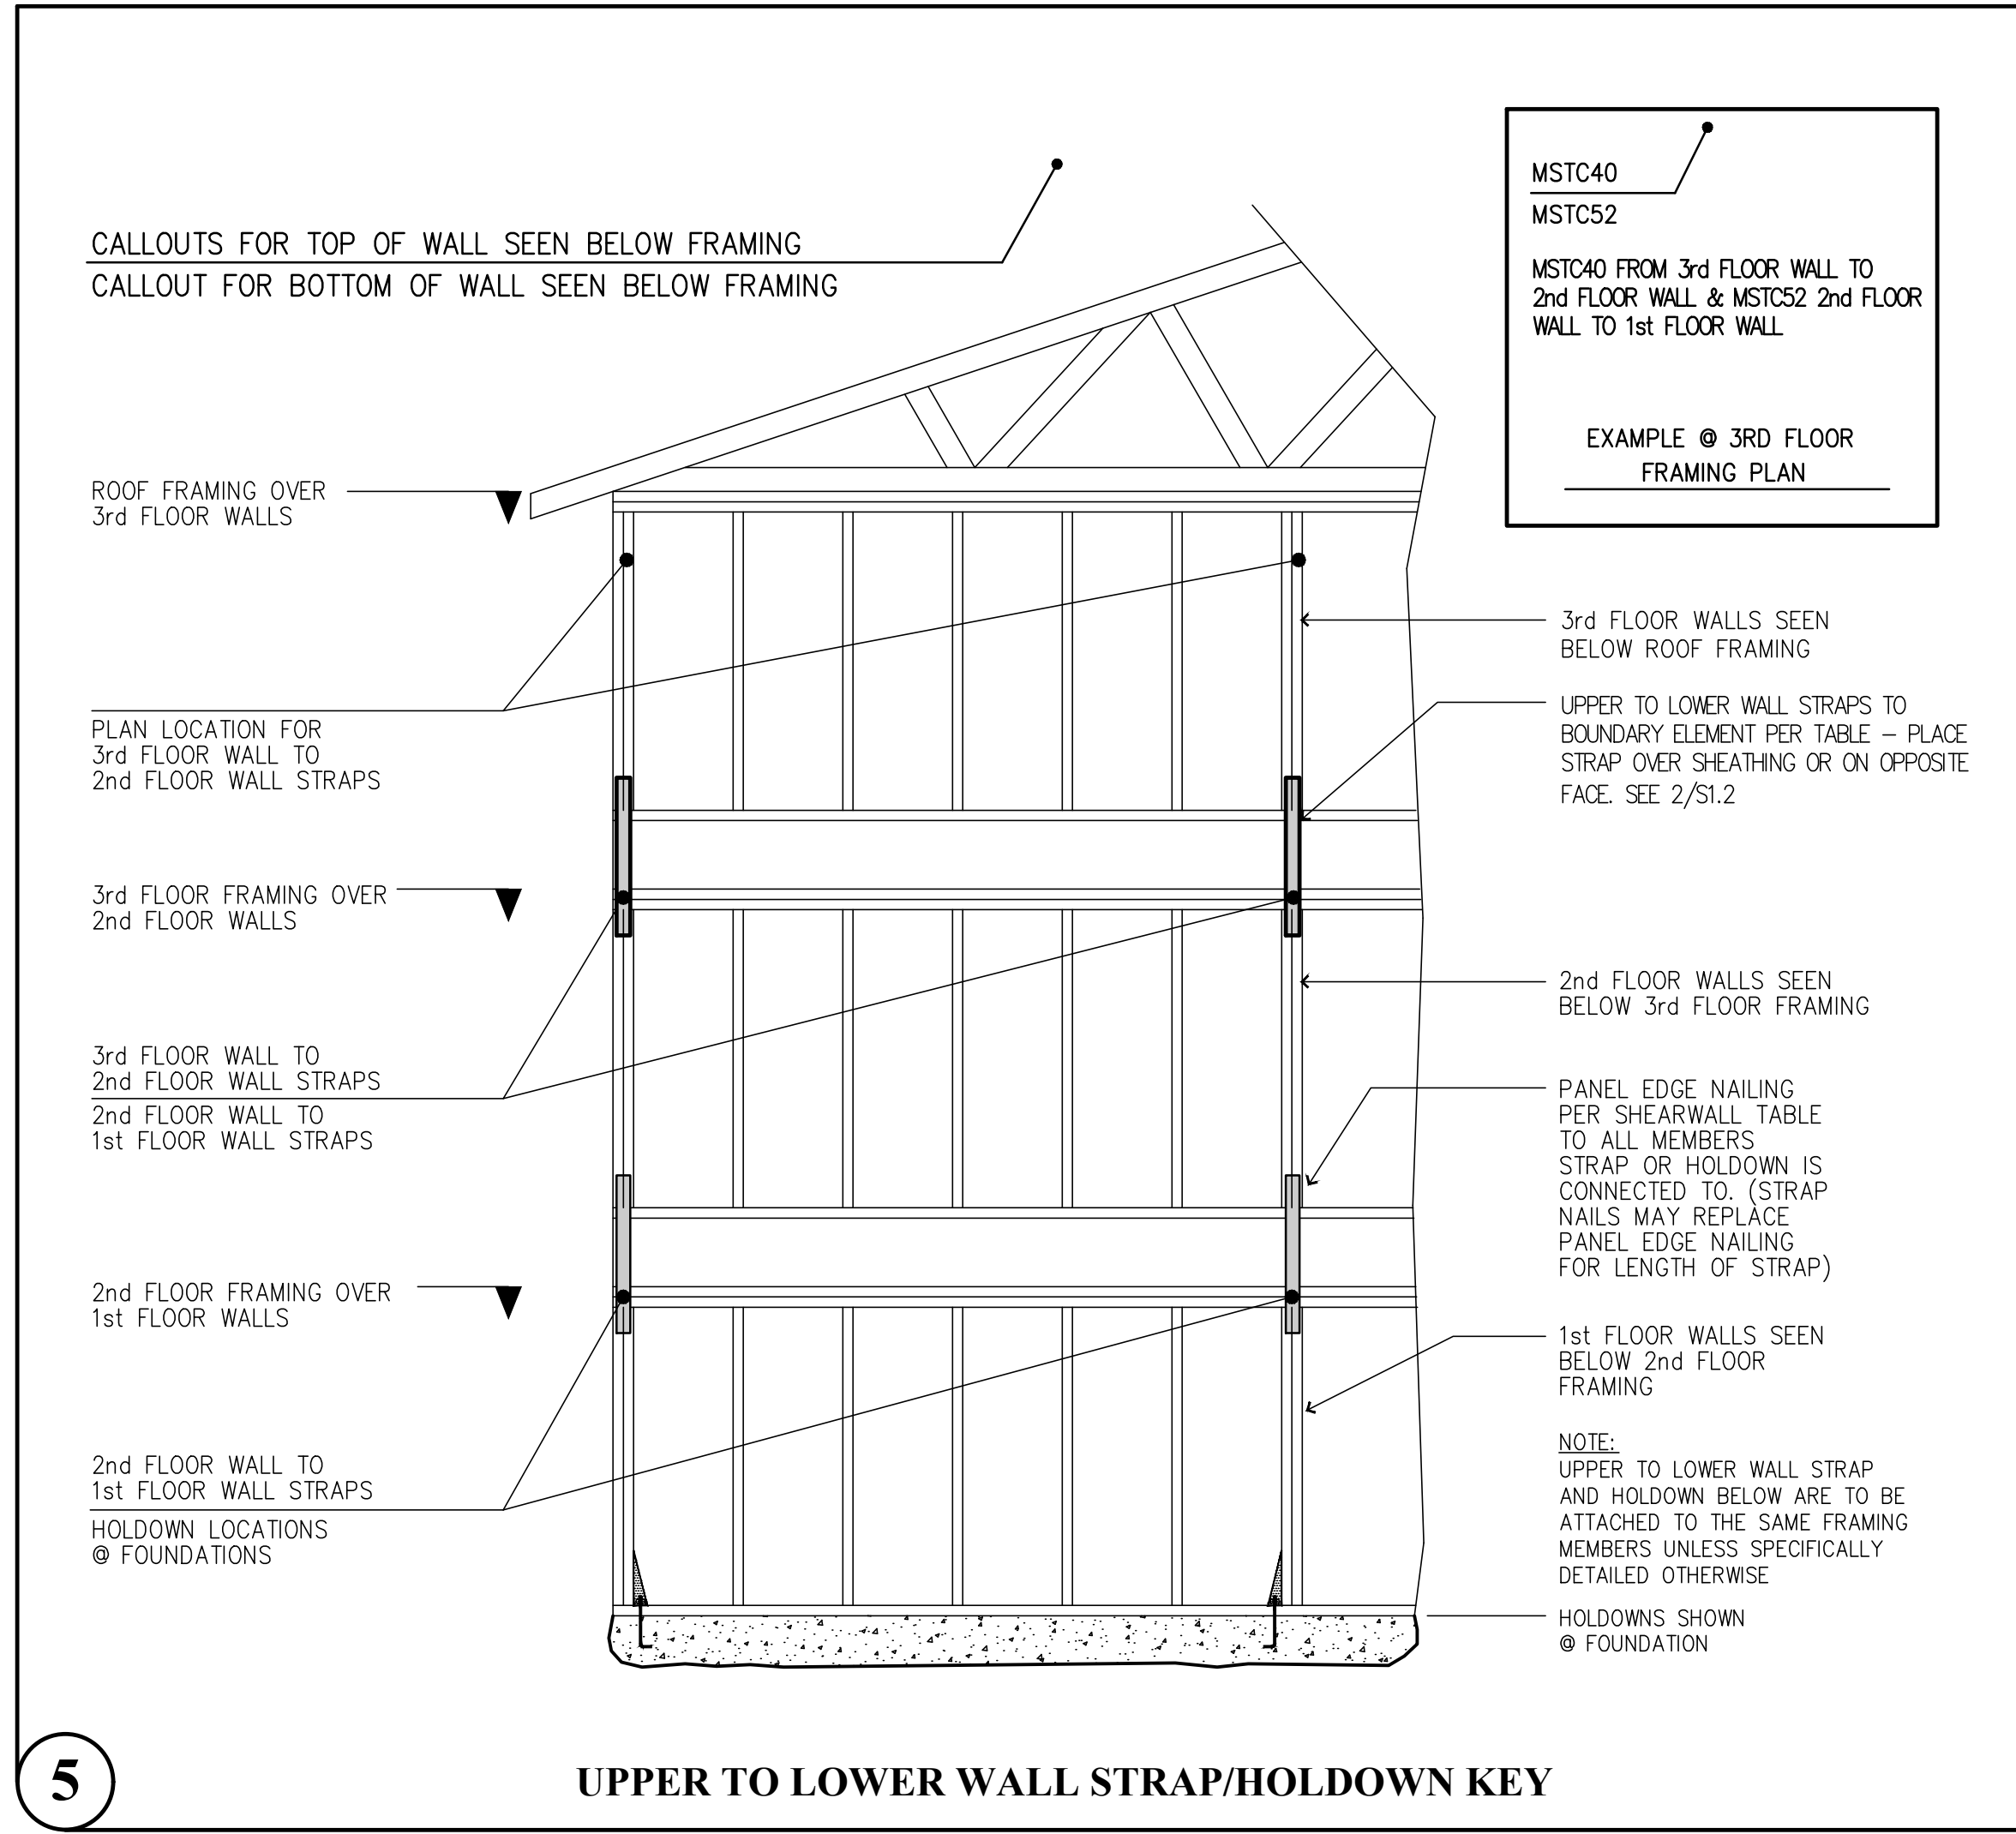

5 UPPER TO LOWER WALL STRAP/HOLDOWN KEY

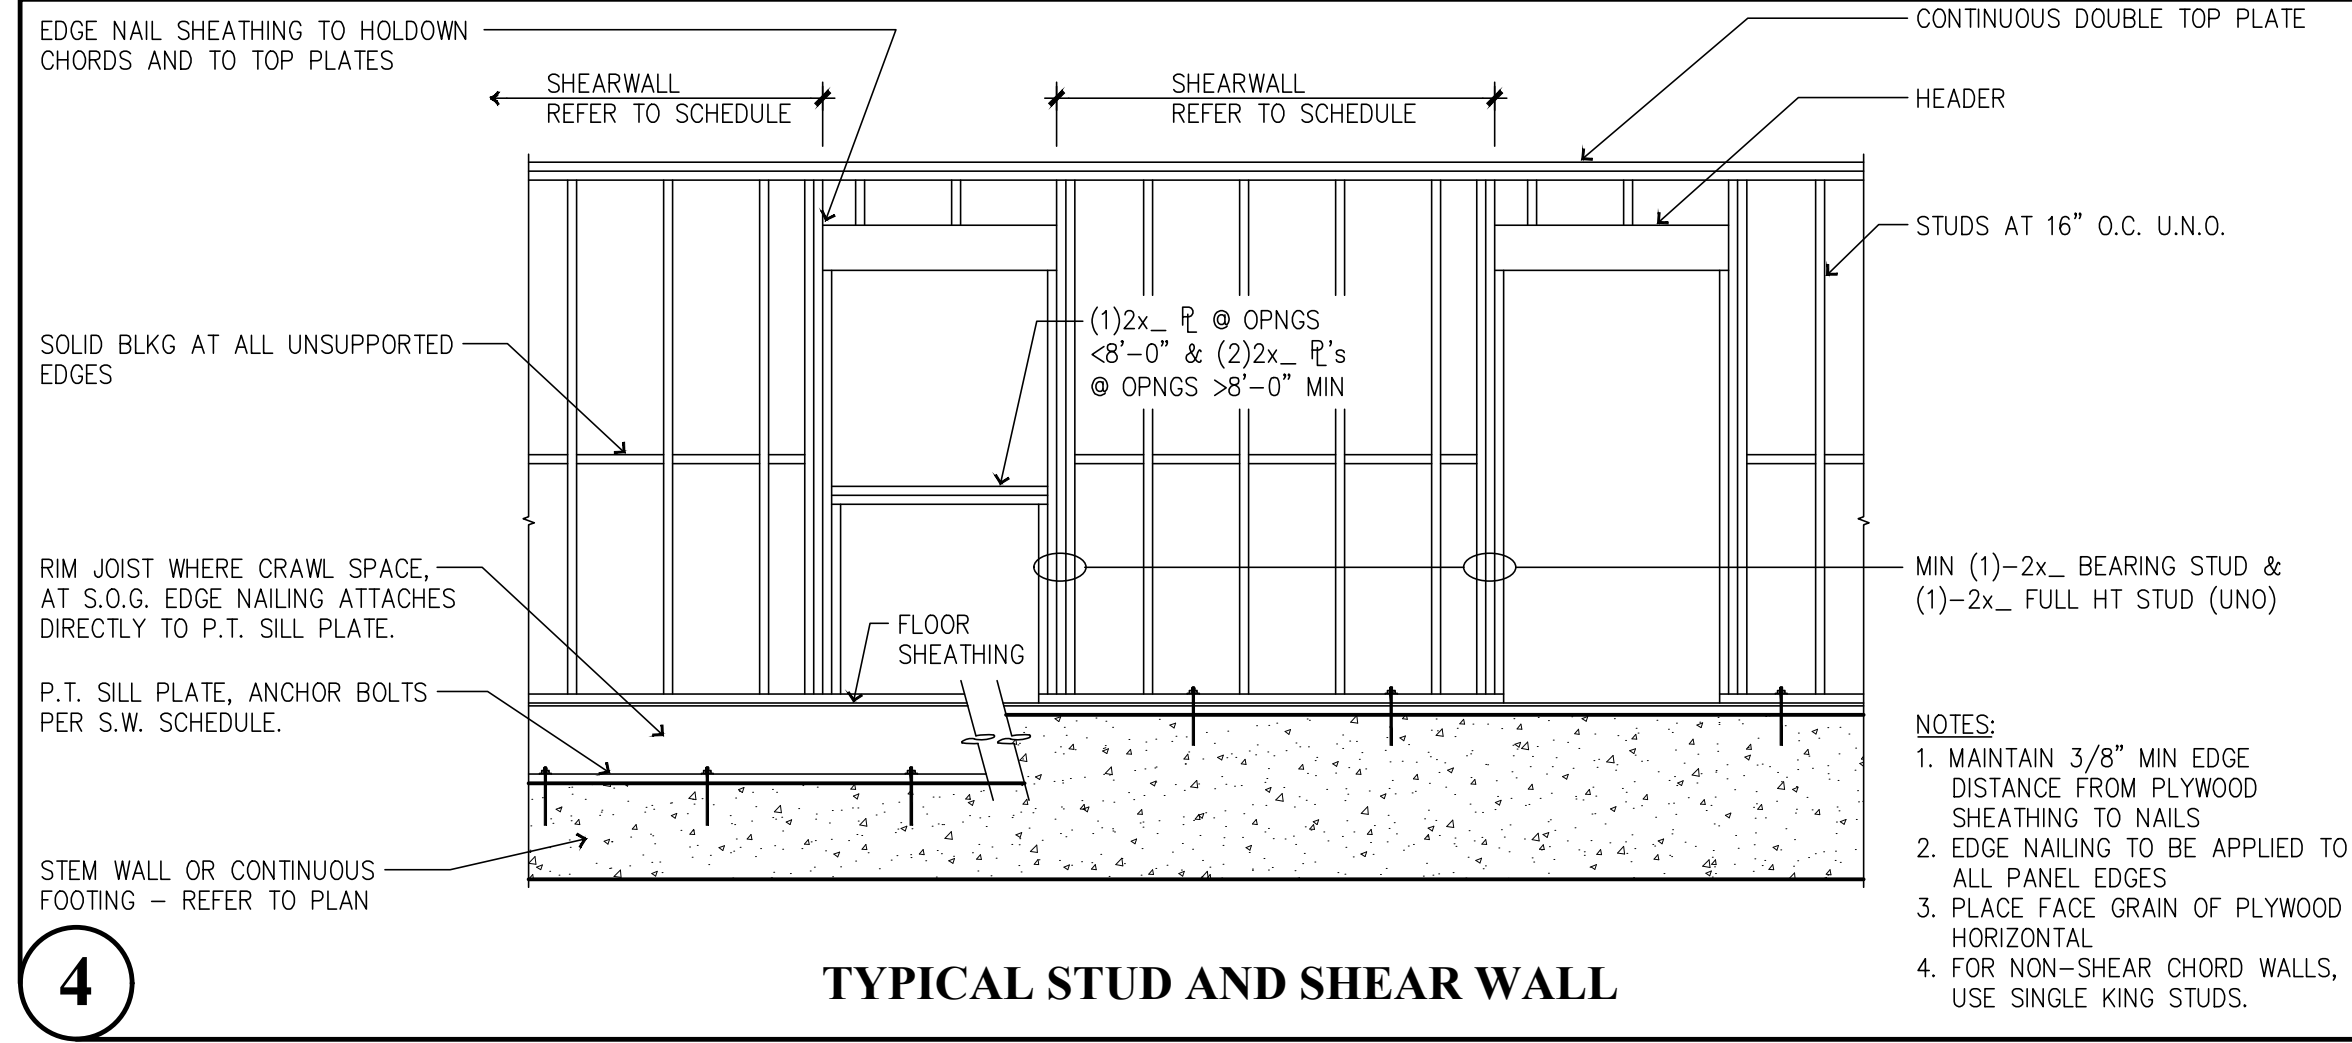

4 TYPICAL STUD AND SHEAR WALL

HOLDOWN TABLE

MARK	BOUNDARY ELEMENT		TOTAL FASTENERS	ANCHOR DIAMETER	ANCHOR EMBEDMENT	MIN EDGE DISTANCE WITHOUT ADD'L REINF
	2x4 WALL	2x6 WALL				
MST37	4x4 #2 HF	4x6 #2 HF	(20) 16d	N/A	N/A	N/A
MST48	4x4 #2 HF	4x6 #2 HF	(32) 16d	N/A	N/A	N/A
(2)MST48	4x6 #2 HF	6x6 #2 DF	(46) 16d	N/A	N/A	N/A
MST60	4x6 #2 HF	4x6 #2 HF	(64) 16d	N/A	N/A	N/A
(2)MST60	4x6 #2 HF	6x6 #2 DF	PER MFR	N/A	N/A	N/A
HDU2	4x4 #2 HF	4x6 #2 HF	PER MFR	5/8"	8"	4"
HDU4	4x4 #2 HF	4x6 #2 HF	PER MFR	5/8"	8"	4"
HDU5	4x6 #2 HF	4x6 #2 HF	PER MFR	5/8"	8"	8"
HDU8	4x6 #2 DF	6x6 #2 DF	PER MFR	7/8"	12"	8"
HDU11	4x6 #2 DF	6x6 #2 DF	PER MFR	1"	12"	12"
HDU14	4x8 #2 DF	6x6 #2 DF	PER MFR	1"	12"	16"

NOTES:

- 1) STRAP HOLDOWNS MAY BE APPLIED DIRECTLY TO BOUNDARY MEMBER ON OPPOSITE SIDE OF SHEATHING OR APPLIED DIRECTLY OVER PWD/OSB SHEATHING. DO NOT LOCATE STRAPS UNDER WOOD SHEATHING OF ANY TYPE OR OVER GYPSUM SHEATHING. (DO NOT INSTALL MSTC TYPE STRAPS OVER SHEATHING, SEE 4/S1.3)
- 2) NAIL SHEATHING PER SHEARWALL TABLE TO EACH BOUNDARY ELEMENT PER TABLE ABOVE.
- 3) ALIGN FLOOR TO FLOOR STRAPS WITH HOLDOWNS AT FOUNDATION, TYP. (SEE DETAIL 5/S1.2)
- 4) HOLDOWNS/STRAPS MUST BE ATTACHED TO FULL HEIGHT MEMBERS UNLESS NOTED OTHERWISE. BOUNDARY ELEMENTS ARE IN ADDITION TO TRIMMER/BEARING STUDS CALLED OUT ON PLAN. (SEE DETAILS 1.2 & 3/S1.3)
- 5) ANCHOR BOLTS SHALL BE CAST IN PLACE AND ALL ANCHORS EXCEPT HDU2 AND HDU4 REQUIRE ADDITIONAL REBAR IF EMBEDDED IN STEMWALLS OR IF MIN EDGE DISTANCE IS LESS THAN AS NOTED USE A STANDARD WASHER WITH A STANDARD NUT ON EACH SIDE AT BOTTOM OF ANCHOR. ADDITIONAL REINFORCEMENT SHALL BE PER DETAILS 1.2, & 3/S1.3.
- 6) THREADED RODS/ANCHORS ARE ASTM A307 OR ASTM F1554 U.N.O.
- 7) STRAPS/HOLDOWNS SHALL BE INSTALLED WITH THE FASTENERS SPECIFIED BY THE MANUFACTURER TO ACHIEVE THE MAXIMUM TABULATED LOAD & AS INDICATED IN THE TABLE ABOVE.
- 8) INSTALL HALF OF SPECIFIED FASTENERS EACH END OF STRAPS PER SIMPSON STRONGTIE.
- 9) SEE DETAIL 4/S1.3 FOR MSTC - HOLDOWN STRAPS FROM SHEARWALL TO BEAM & DETAIL 6/S1.3 FOR MSTC - HOLDOWN STRAPS @ END OF BEAM TO POST/COLUMN. (*) SYMBOL AT END OF MSTC STRAP CALLOUT (i.e. (2)MSTC48B3*) INDICATES STRAP IS INVERTED AND ATTACHES END OF BEAM TO POST BELOW PER 6/S1.3

SHEARWALL COMPONENT TABLE


MARK	MARK ¹⁴	COMPONENTS	1/2" A.B. PL TO CONCRETE SPACING (IN)	5/8" A.B. PL TO CONCRETE SPACING (IN)	10d COMMON PL TO PL SPACING (IN)	SIMPSON A35 CLIP ANGLE SPACING (IN)	SIMPSON LTP4 CLIP ANGLE SPACING (IN)
W1	W1P	7/16" PWD OR OSB, BLOCKED, W/ 8d NAILS @ 6" O.C. @ PANEL EDGES AND @ 12" O.C. @ FIELD.	47" O.C.	68" O.C.	8.1" O.C.	30" O.C.	29" O.C.
W2	W2P	7/16" PWD OR OSB, BLOCKED, W/ 8d NAILS @ 4" O.C. @ PANEL EDGES AND @ 12" O.C. @ FIELD.	32" O.C.	47" O.C.	5.5" O.C.	20" O.C.	20" O.C.
W3	W3P	7/16" PWD OR OSB, BLOCKED, W/ 8d NAILS @ 3" O.C. @ PANEL EDGES AND @ 12" O.C. @ FIELD. SEE NOTE 2	25" O.C.	36" O.C.	4.3" O.C.	16" O.C.	15" O.C.
W4	W4P	7/16" PWD OR OSB, BLOCKED, W/ 8d NAILS @ 2" O.C. @ PANEL EDGES AND @ 12" O.C. @ FIELD. SEE NOTE 2	19" O.C.	28" O.C.	6.6" O.C. EA ROW	12" O.C.	12" O.C.
W5	W5P	7/16" PWD OR OSB, BLOCKED, W/ 10d NAILS @ 2" O.C. @ PANEL EDGES AND @ 12" O.C. @ FIELD. SEE NOTE 2.	16" O.C.	23" O.C.	5.6" O.C. EA ROW	10" O.C.	10" O.C.
W6	W6P	15/32" PWD OR OSB, (2) LAYERS (ONE EACH SIDE), BLOCKED, W/ 10d NAILS @ 3" O.C. @ PANEL EDGES AND @ 12" O.C. @ FIELD. SEE NOTE 2, 3 & 15	12" O.C.	18" O.C.	4.3" O.C. EA ROW	8" O.C.	8" O.C.
W7	W7P	15/32" PWD OR OSB, (2) LAYERS (ONE EACH SIDE), BLOCKED, W/ 10d NAILS @ 2" O.C. @ PANEL EDGES AND @ 12" O.C. @ FIELD. SEE NOTE 2, 3, & 15	9" O.C.	14" O.C.	3" O.C. EA ROW STAGGERED	5" O.C.	5" O.C.

NOTES:

1. ALL NAILING PER ANS/AF & PA SDPWS - 2018 TABLE 4.3A
2. USE 3x STUDS AT ALL ABUTTING PANEL EDGES. NAILS SHALL BE STAGGERED WHERE NAILS ARE SPACED AT 2" O.C.
3. IF CALLOUT REQUIRES BLOCKING, SHEATHING MAY BE PLACED WITH THE LONGITUDINAL DIRECTION VERTICAL. STUDS AND PLATES WILL BE CONSIDERED TO ACT AS BLOCKING.
4. WALL SHEATHING CALLED OUT SHALL EXTEND FOR ENTIRE WALL LENGTH AT THAT ELEVATION AND SHALL BE CONTINUOUS AROUND OPENINGS TYPICALLY.
5. 8d NAILS ARE TO BE .131" AND 2-1/2" IN LENGTH. 10d NAILS ARE TO BE .148" AND A MINIMUM OF 3" IN LENGTH. 16d NAILS ARE TO BE .162" AND 3-1/4" IN LENGTH. NAILS SHALL BE INSTALLED SO AS TO NOT SPLIT THE TIMBER FRAMING.
6. SIMPSON A35 OR LTP4 CLIP ANGLES SHALL BE INSTALLED WITH THE APPROPRIATE FASTENERS PER THE MANUFACTURER'S SPECIFICATIONS.
7. USE 3"x3"x0.229" PLATE WASHERS AT ALL ANCHOR BOLTS PER SECTION 4.3.6.4.3
8. SPACING SHOWN ABOVE FOR ANCHOR BOLTS, NAILING AND CLIPS IS MAXIMUM AMOUNT ALLOWED.
9. FRAMING AT SHEARWALLS SHALL BE SPACED NO FARTHER THAN 16" O.C.

10. MINIMUM NAIL SPACING IN A SINGLE ROW SHALL BE 4 INCHES ON CENTER. USE (2) ROWS IF SPACING LESS THAN THIS. USE 2ND RIM BOARD, RIM JOIST OR BLOCKING WHERE THREE ROWS OF NAILING CALLED OUT.
11. EXTEND SHEATHING UP TO DOUBLE TOP PLATES AND INSTALL NAILS THROUGH SHEATHING INTO UPPER TOP PLATE PER TYPICAL DETAILS. NO PLATE TO PLATE NAILING REQUIRED IN DOUBLE TOP PLATES WITH THIS CONFIGURATION.
12. OPTIONAL TO USE (2) 2x's IN PLACE OF SINGLE 3x IN SHEARWALLS W3, W4 AND W5 W/ STITCH NAILING.
13. (2) ROWS OF 0.148" x 3" STITCH NAILING (2)2x STUDS TOGETHER @ 10" O.C. FOR W3 SHW, 8" O.C. FOR W4 SHW & 6" O.C. FOR W5 SHW PER SECTION 4.3.7 NOTE 4.
14. THE "W_P" INDICATES SHEAR WALL TYPE WITH OPENINGS. PROVIDE SHEATHING AROUND ALL OPENINGS AND ABOVE AND BELOW ALL OPENINGS. PROVIDE HORIZONTAL STRAPS & NAILING AT OPENINGS PER 8/S1.2

1

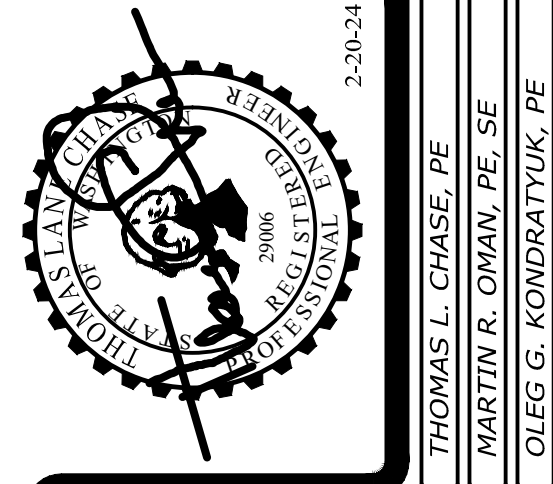

Revisions to this sheet:

Bradley Heights Apartments
202 27th Ave SE
Puyallup, Washington

Solutions 4 Structures
A Structural Engineering Corporation

PROJECT NO. : 23-007
DESIGNED BY : TLC, OGG, MRO
DRAWN BY : RSO
ISSUE DATE : 2-20-24
LATEST REV. OF DWG. SET :






















THOMAS L. CHASE, PE
MARTIN R. OMAN, PE, SE
OLEG G. KONDRATYUK, PE

Puyallup, Washington 98374
Ph. 253-314-9822
www.solutions4structures.com

SUBMITTAL SET ONLY NOT FOR CONSTRUCTION
THESE DRAWINGS ARE SUBJECT TO REVISIONS PENDING LOCAL JURISDICTIONAL REVIEW.

S1.2

CAD FILE: F:\Projects\2023\Projects\23.007 Bradley Heights\Drawings\51.3.dwg
 PLOT DATE/TIME: 2/15/2024 - 9:24am THANK YOU FOR USING SOLUTIONS 4 STRUCTURES

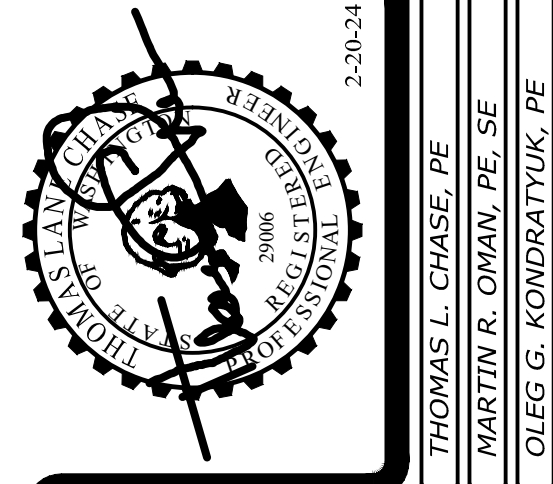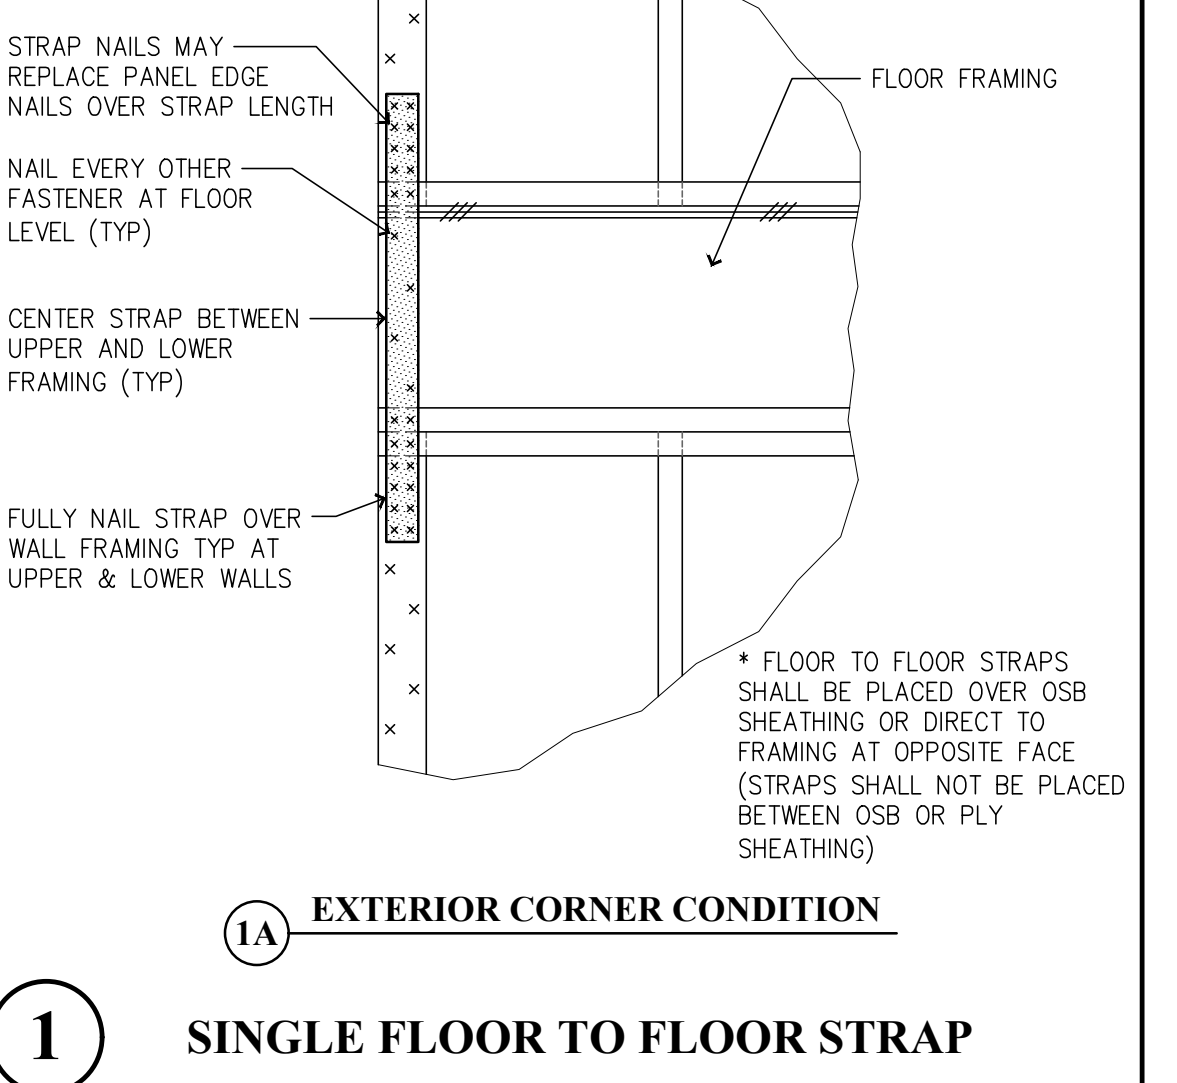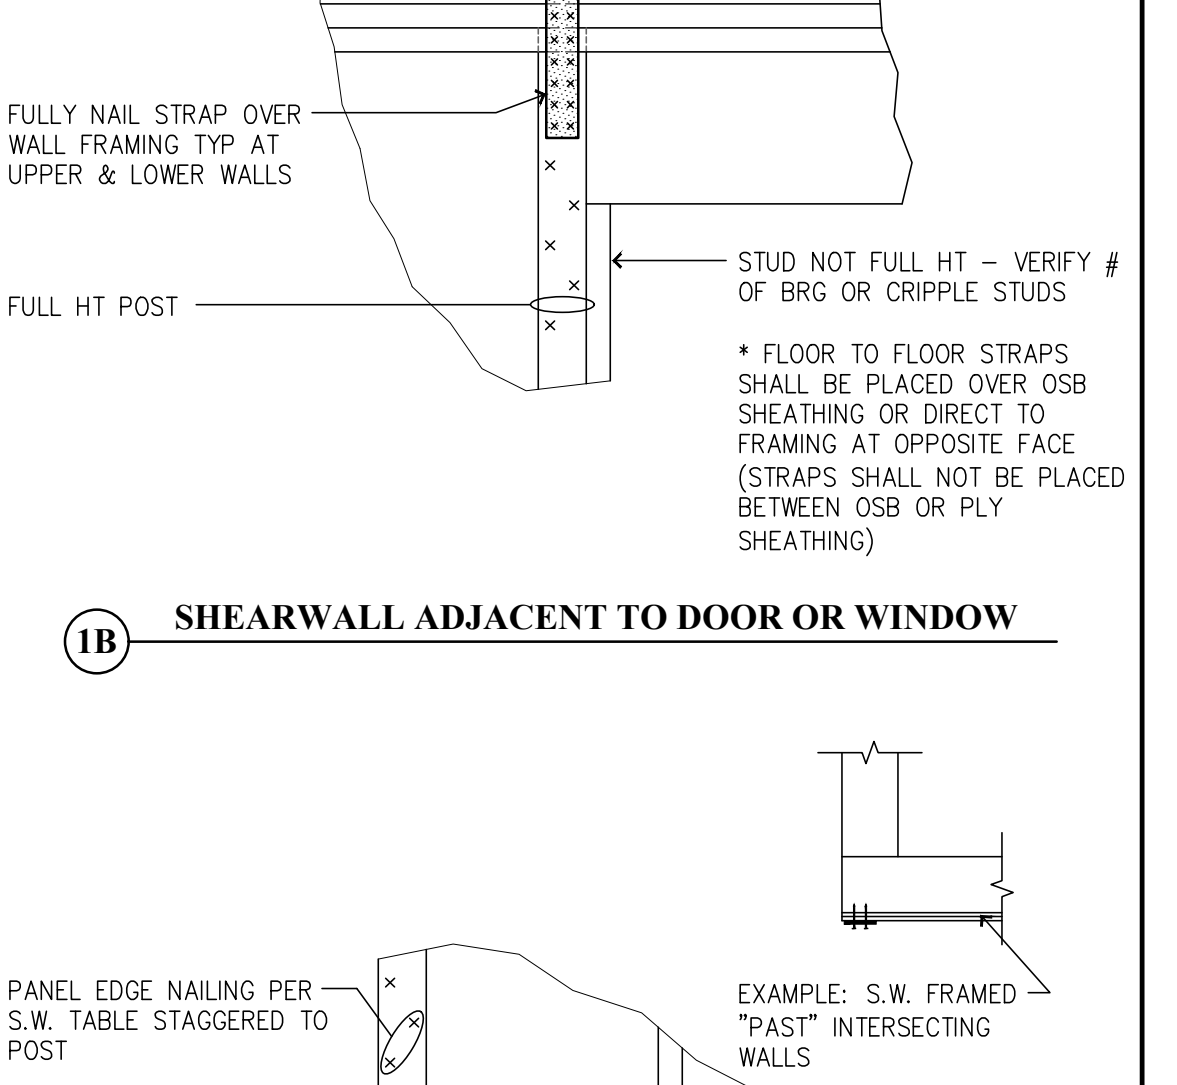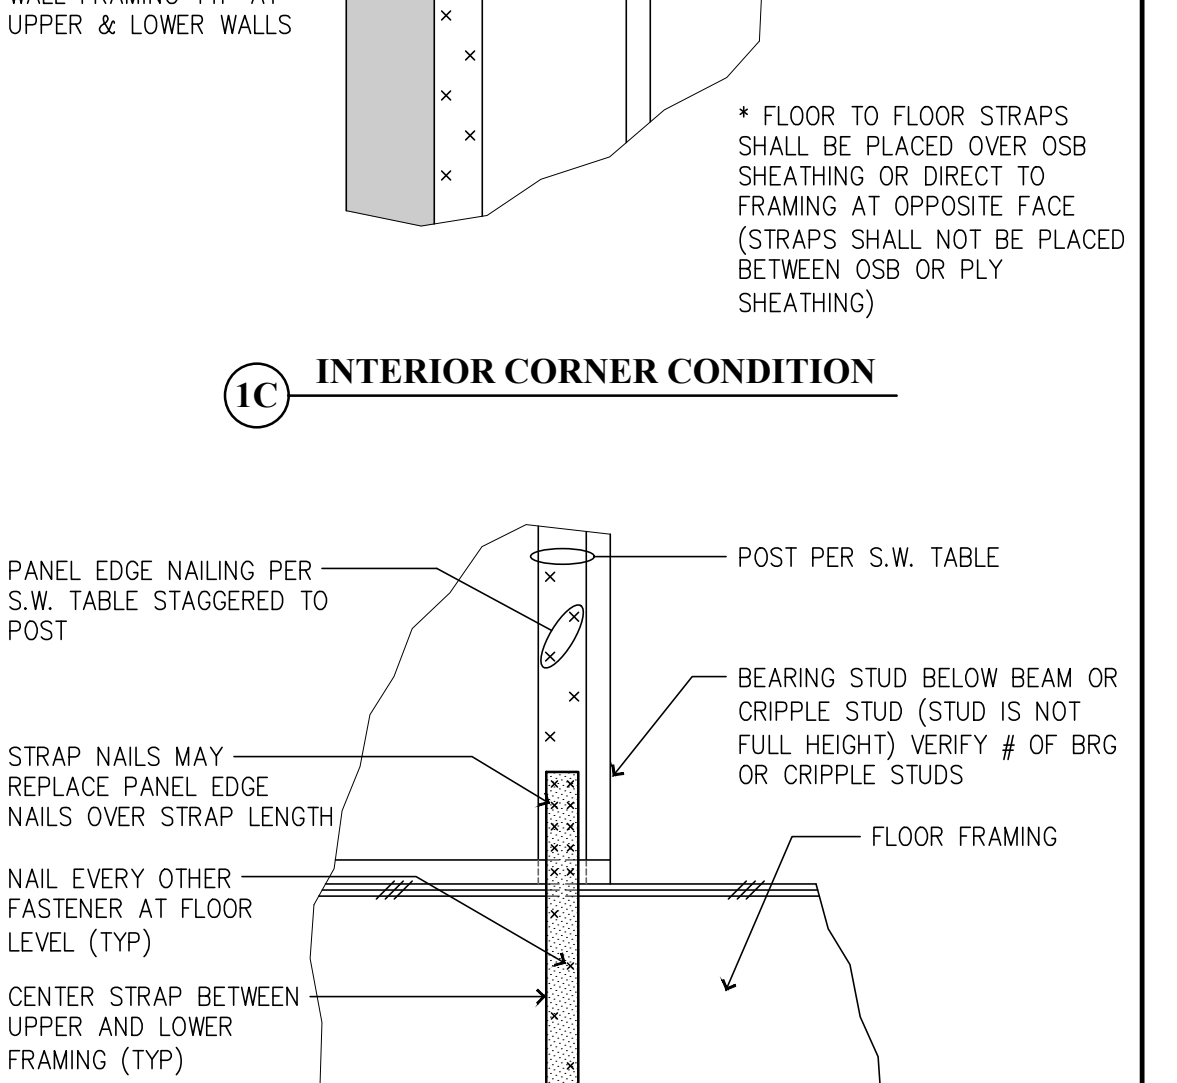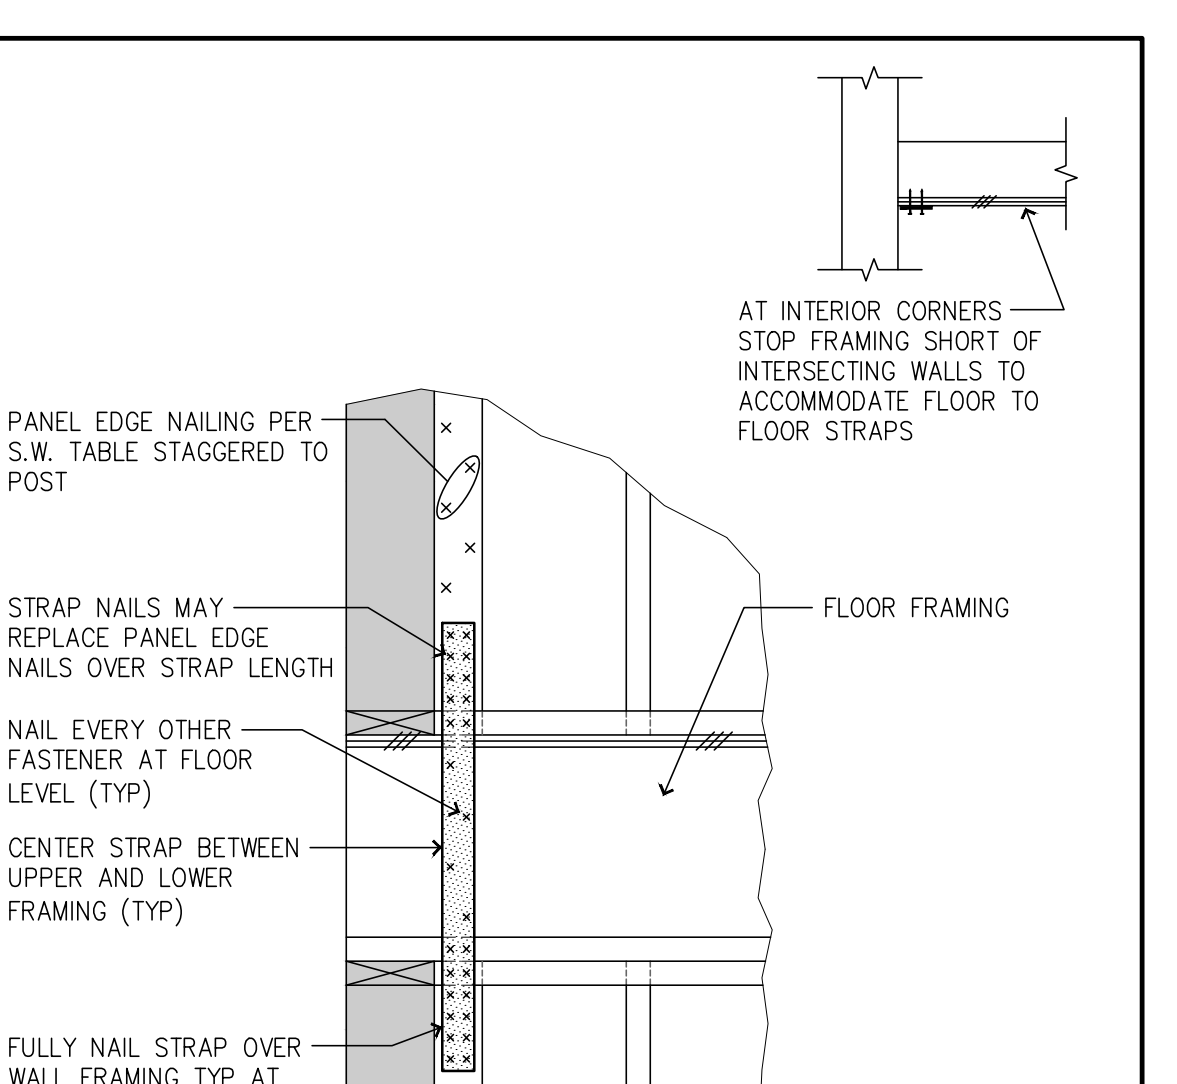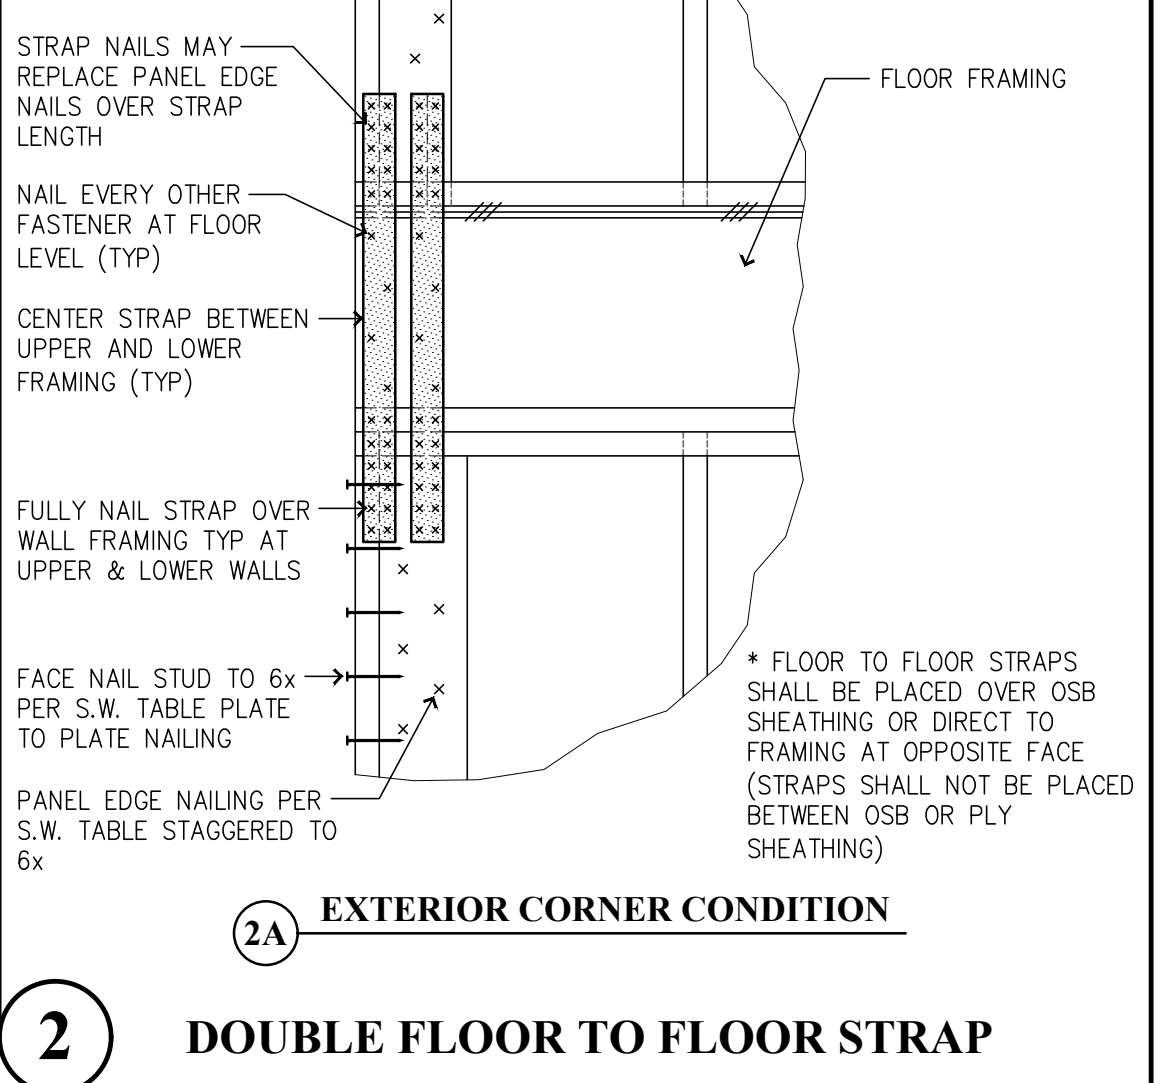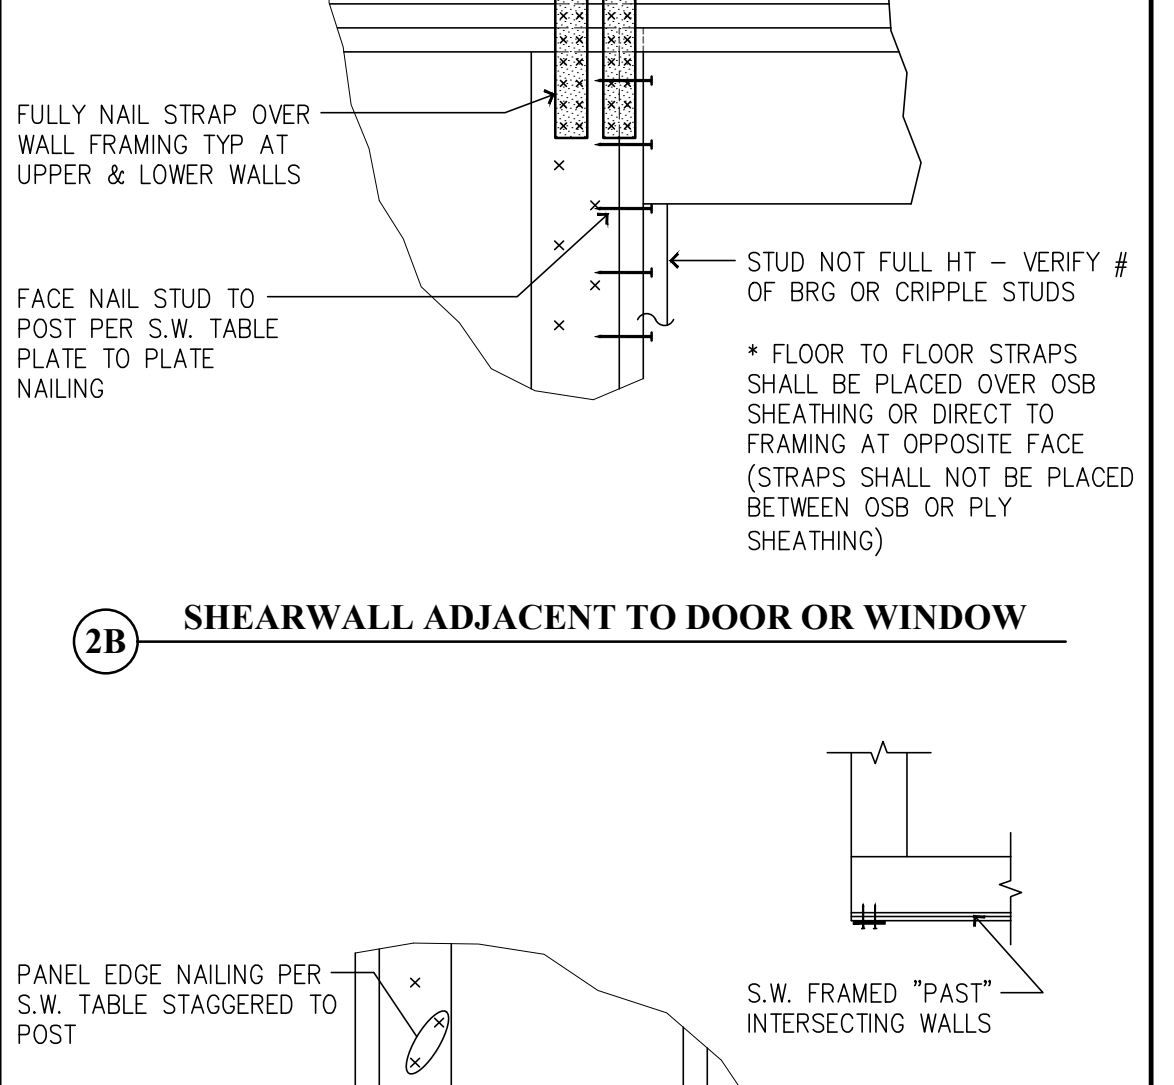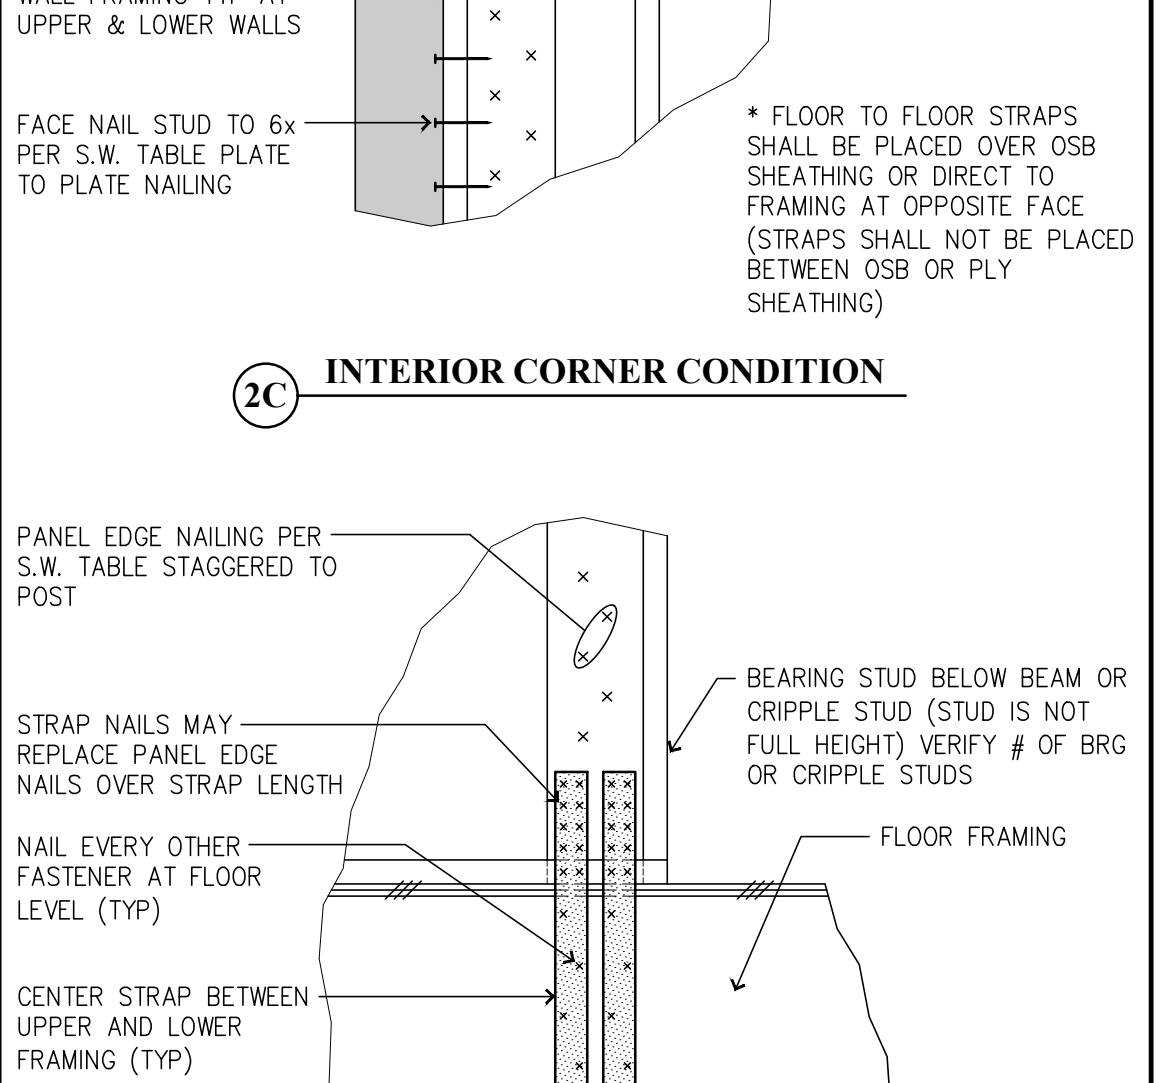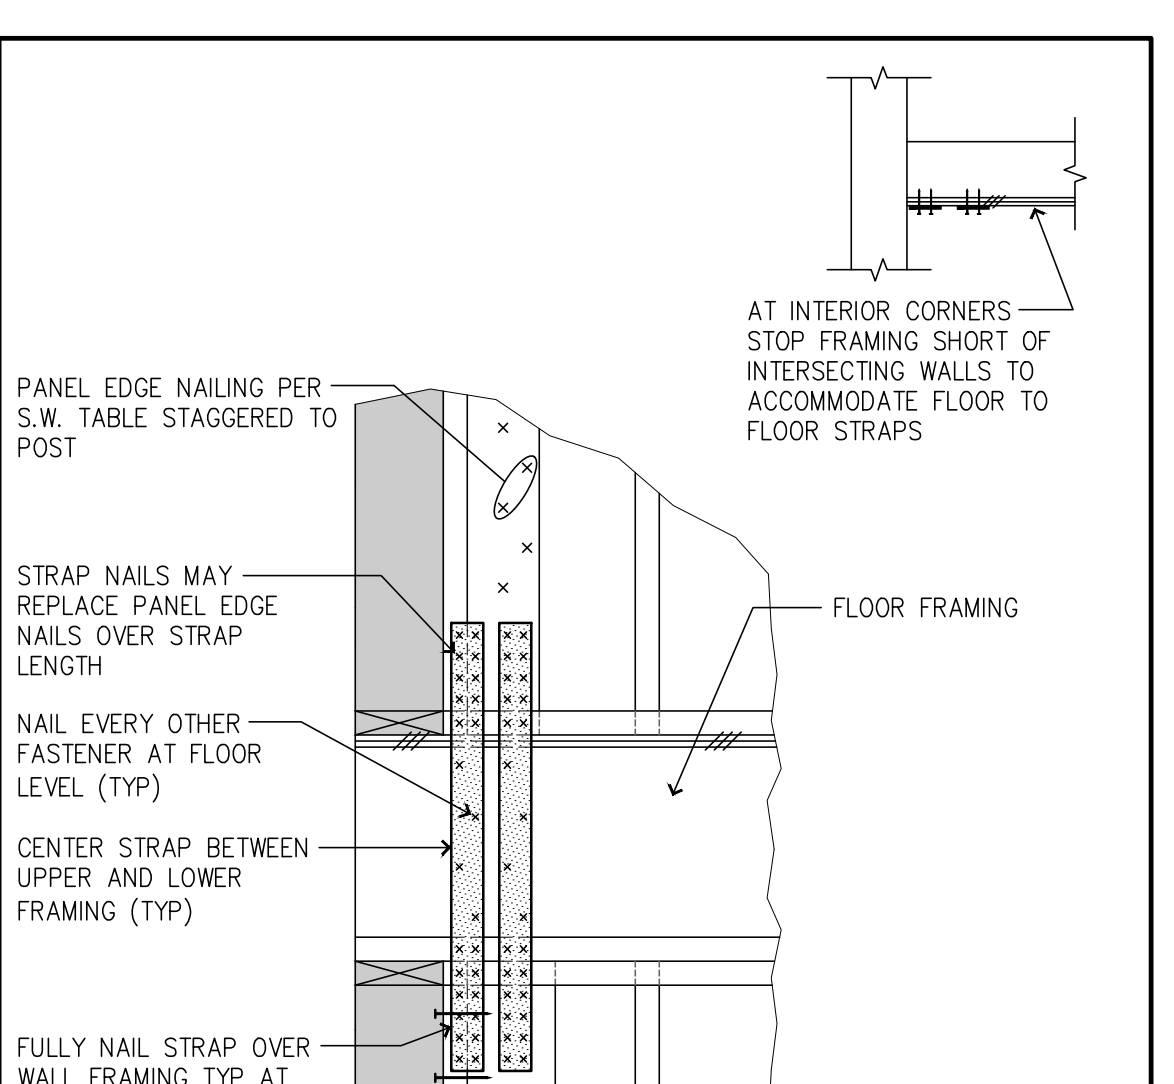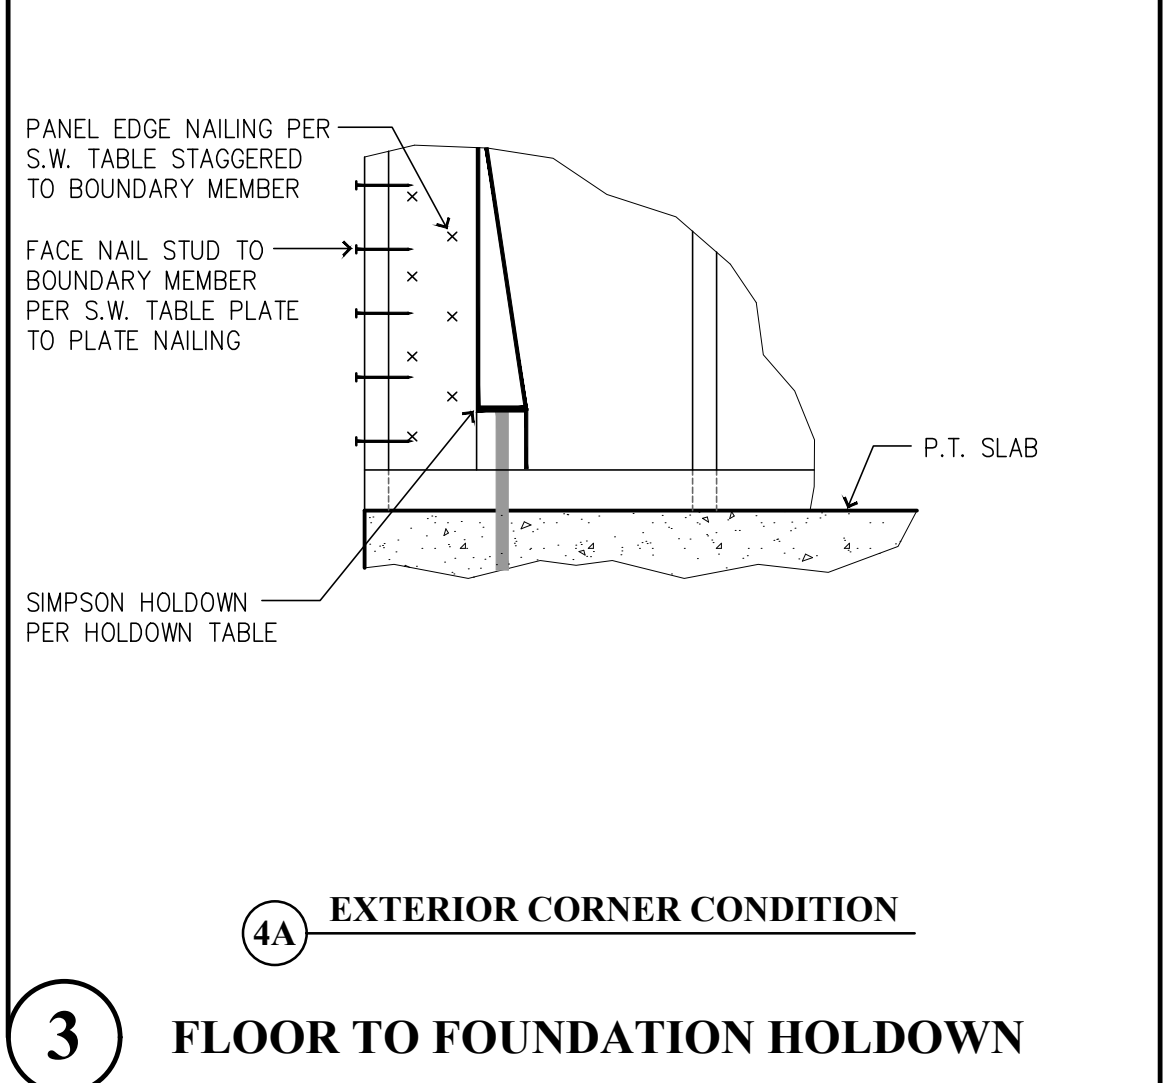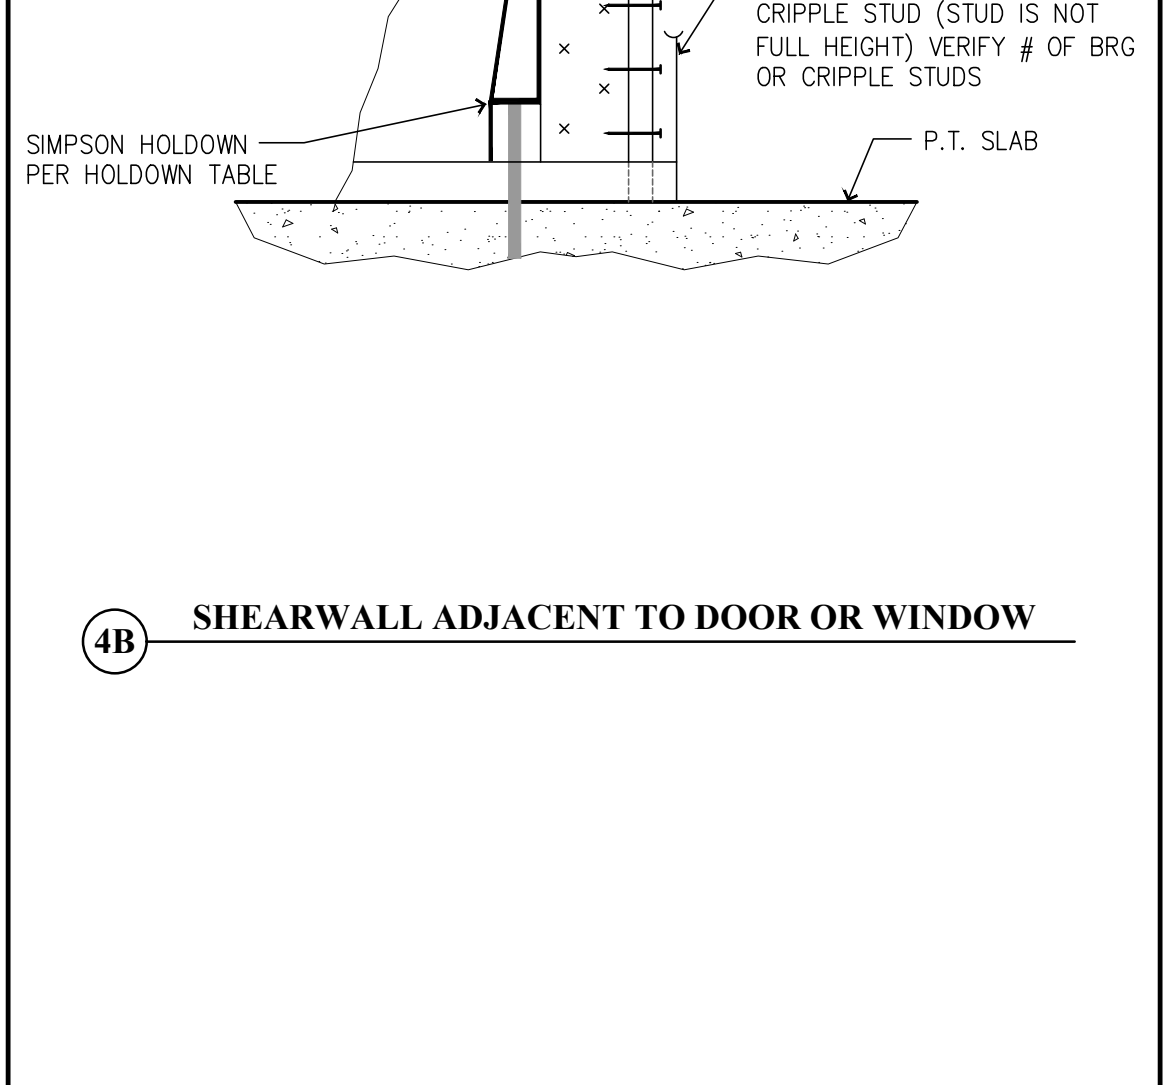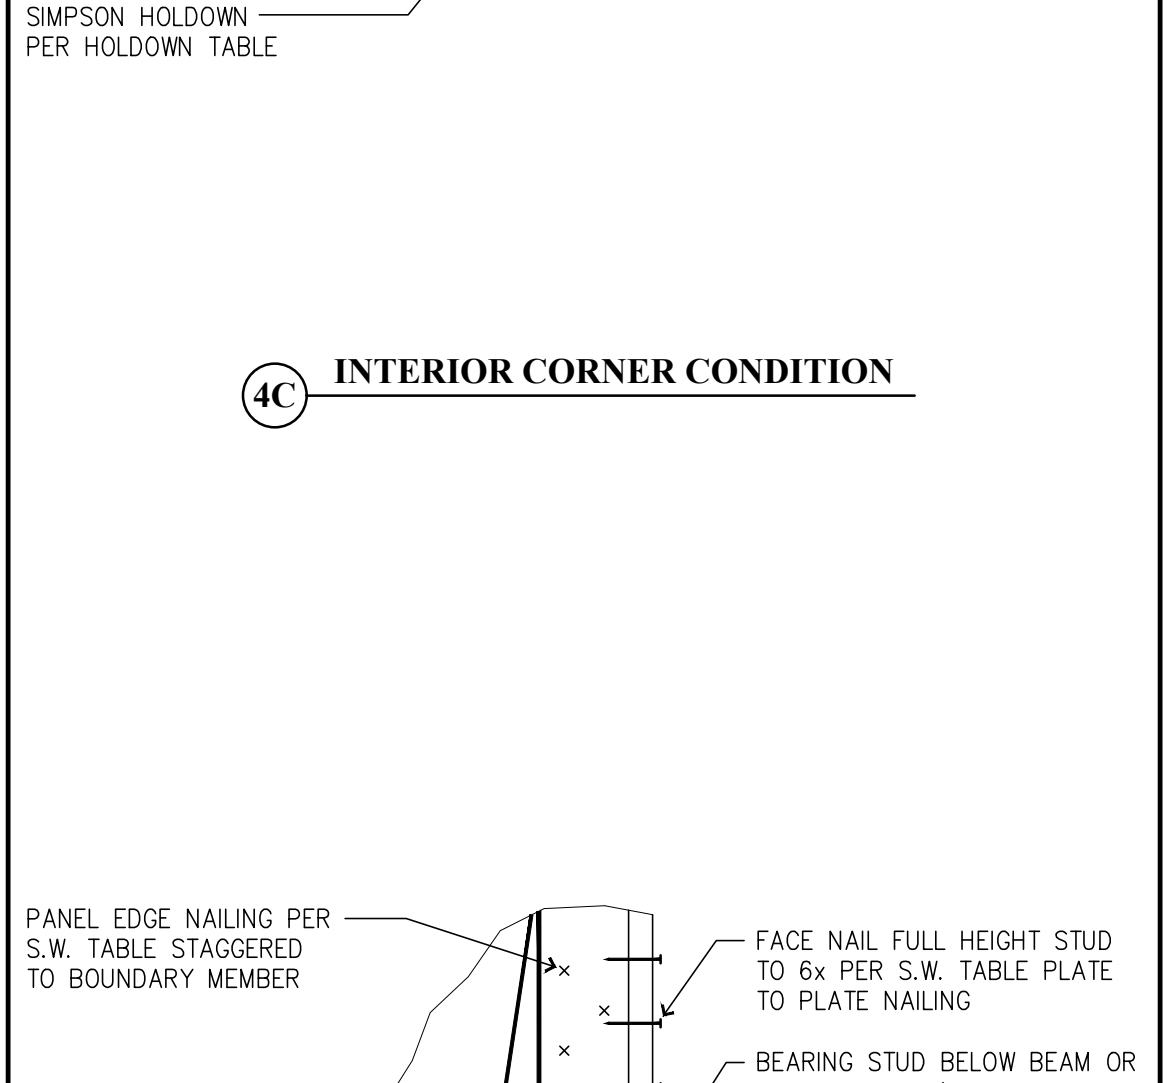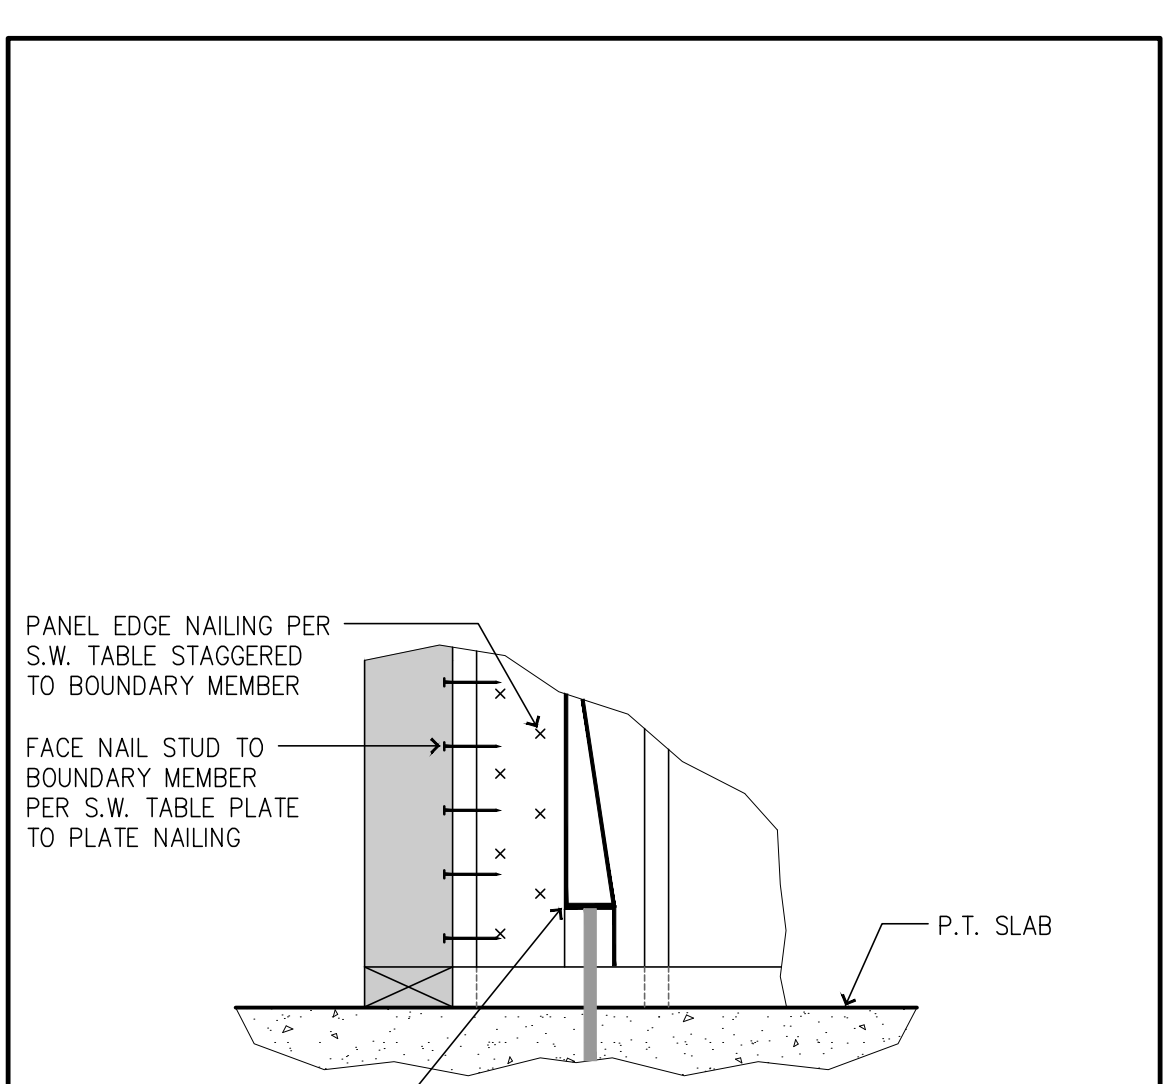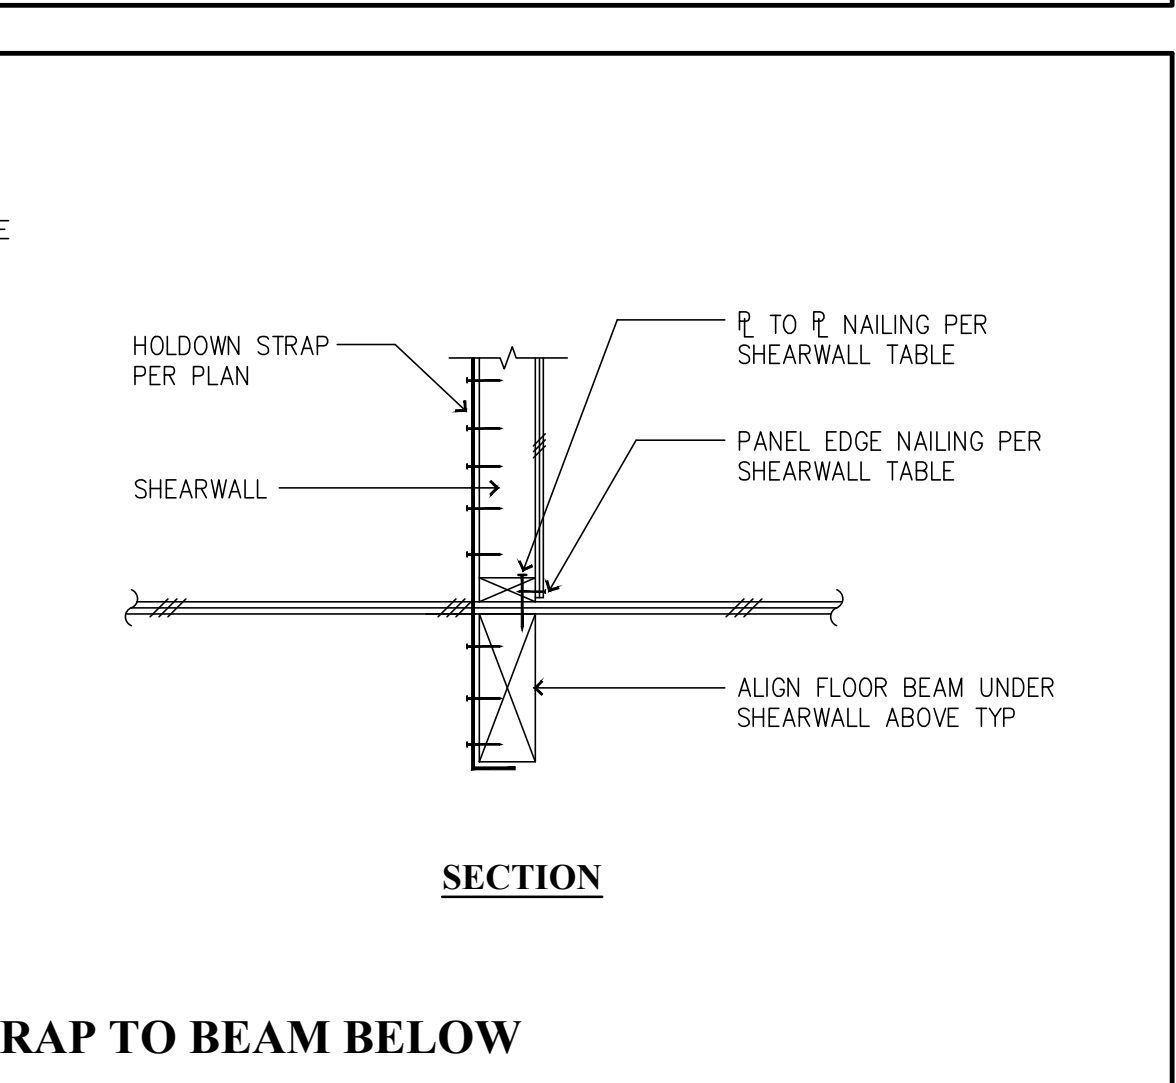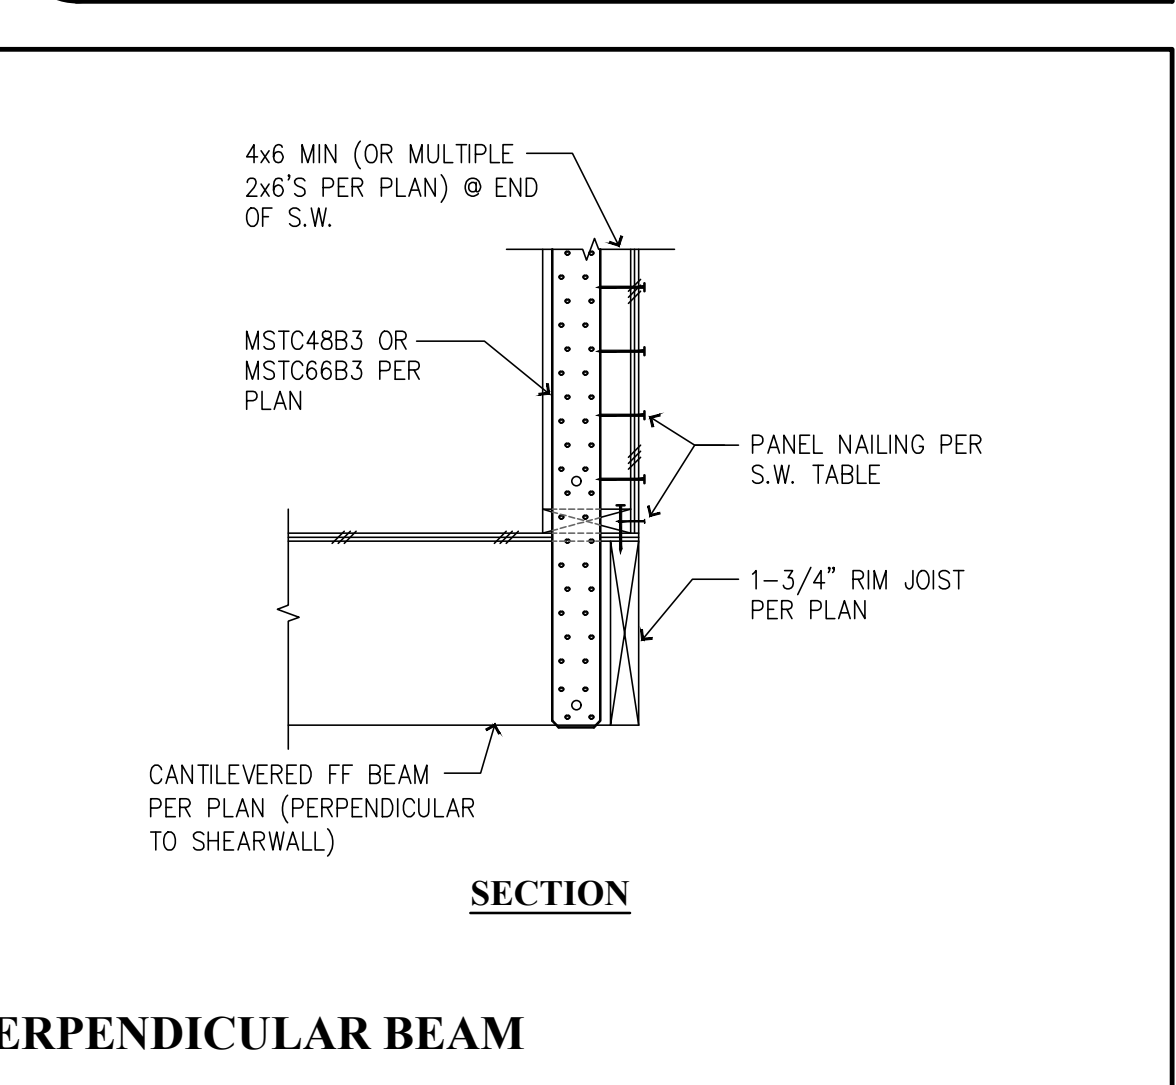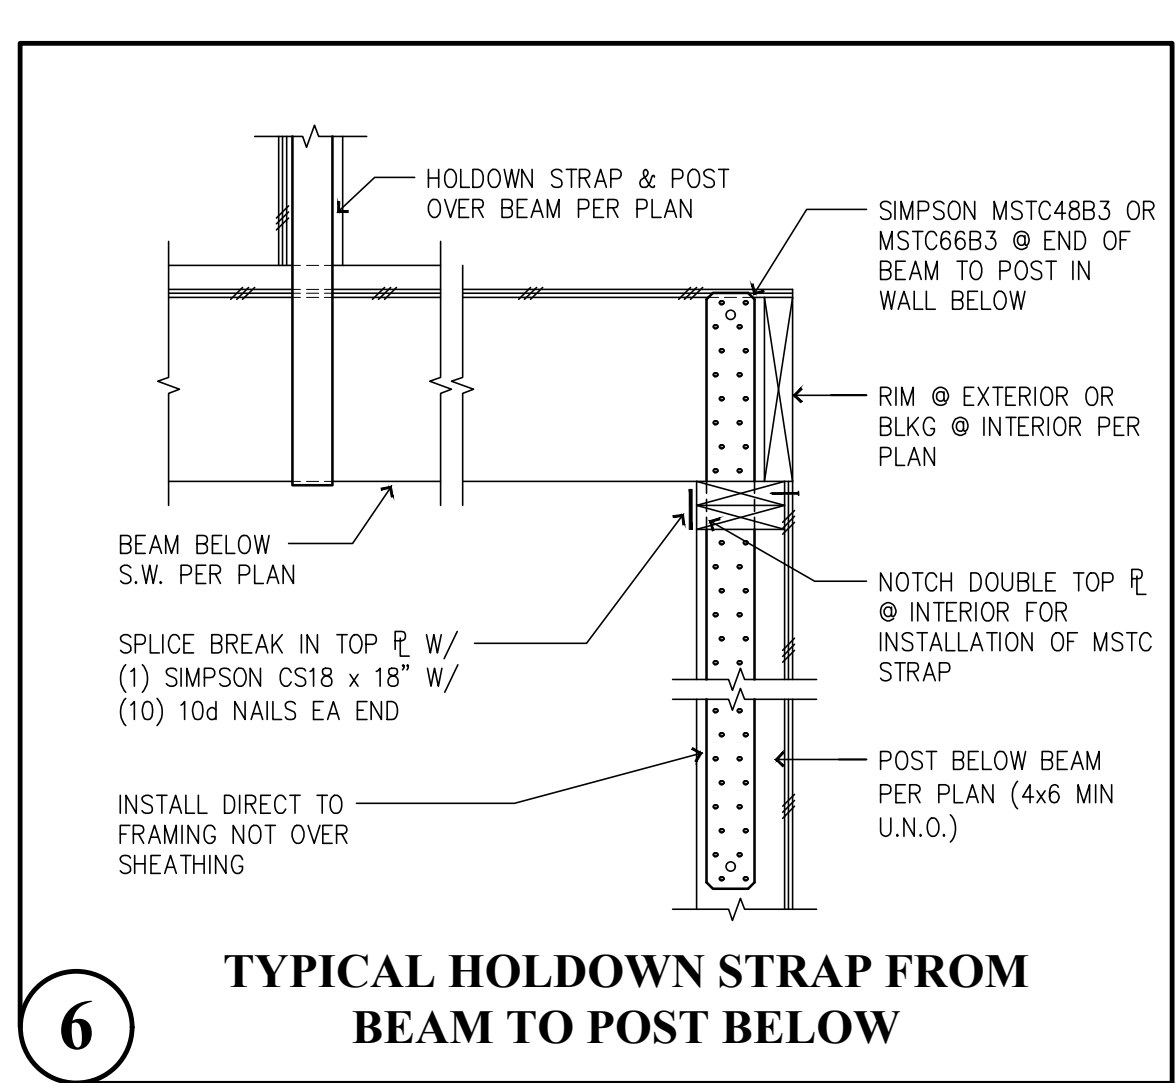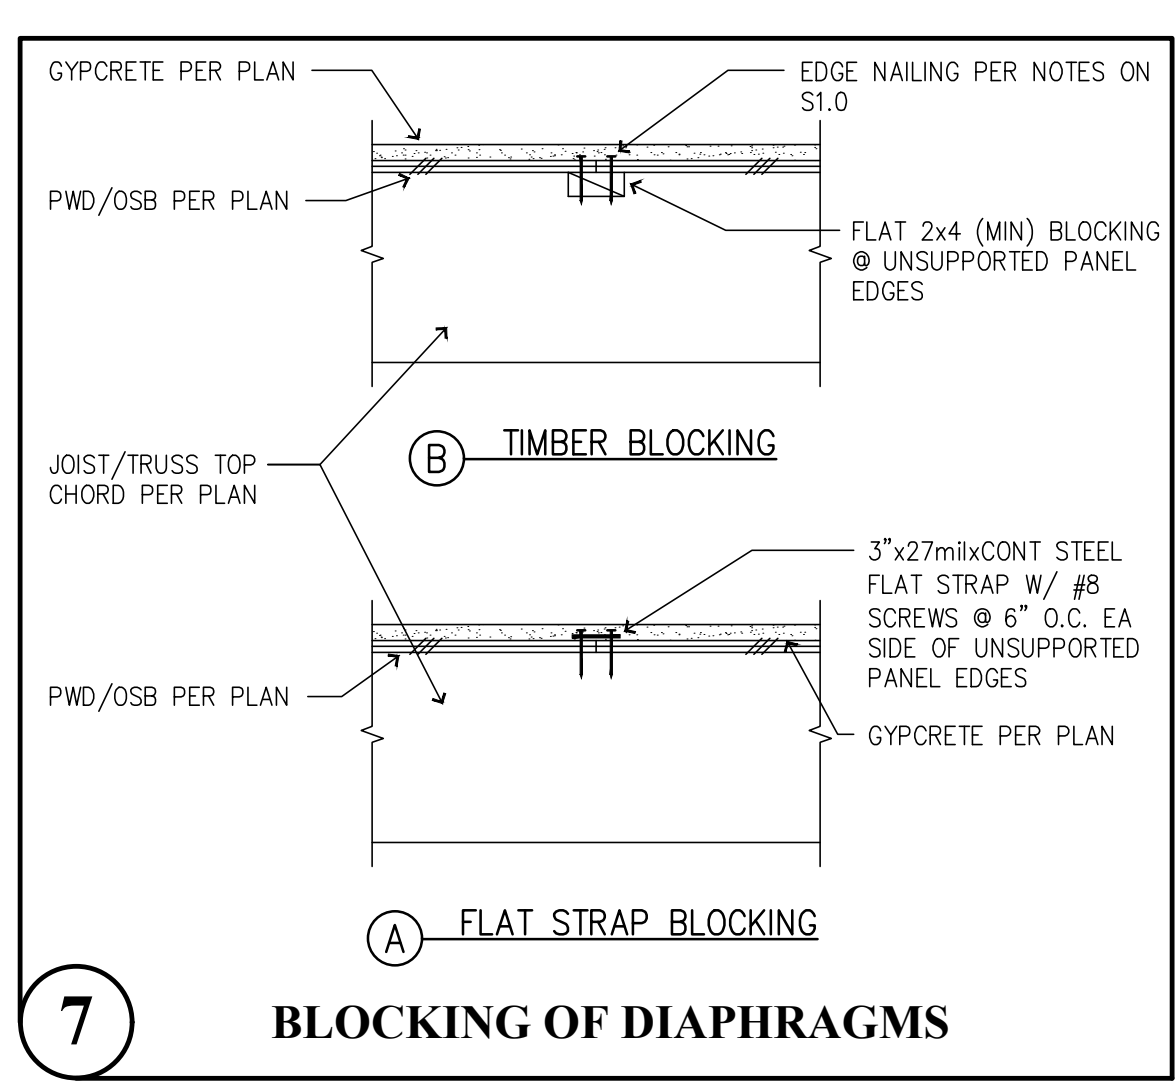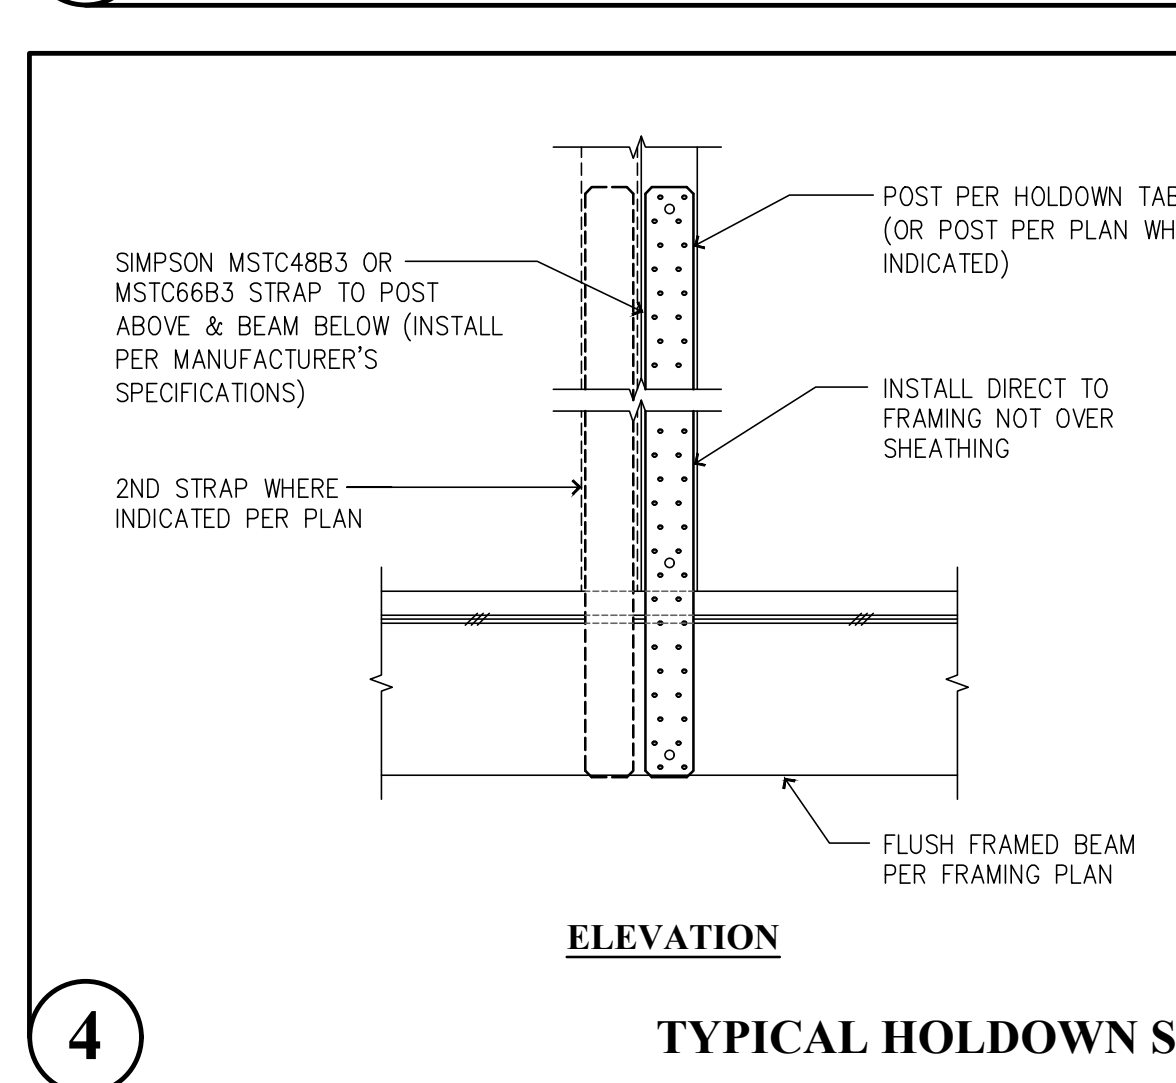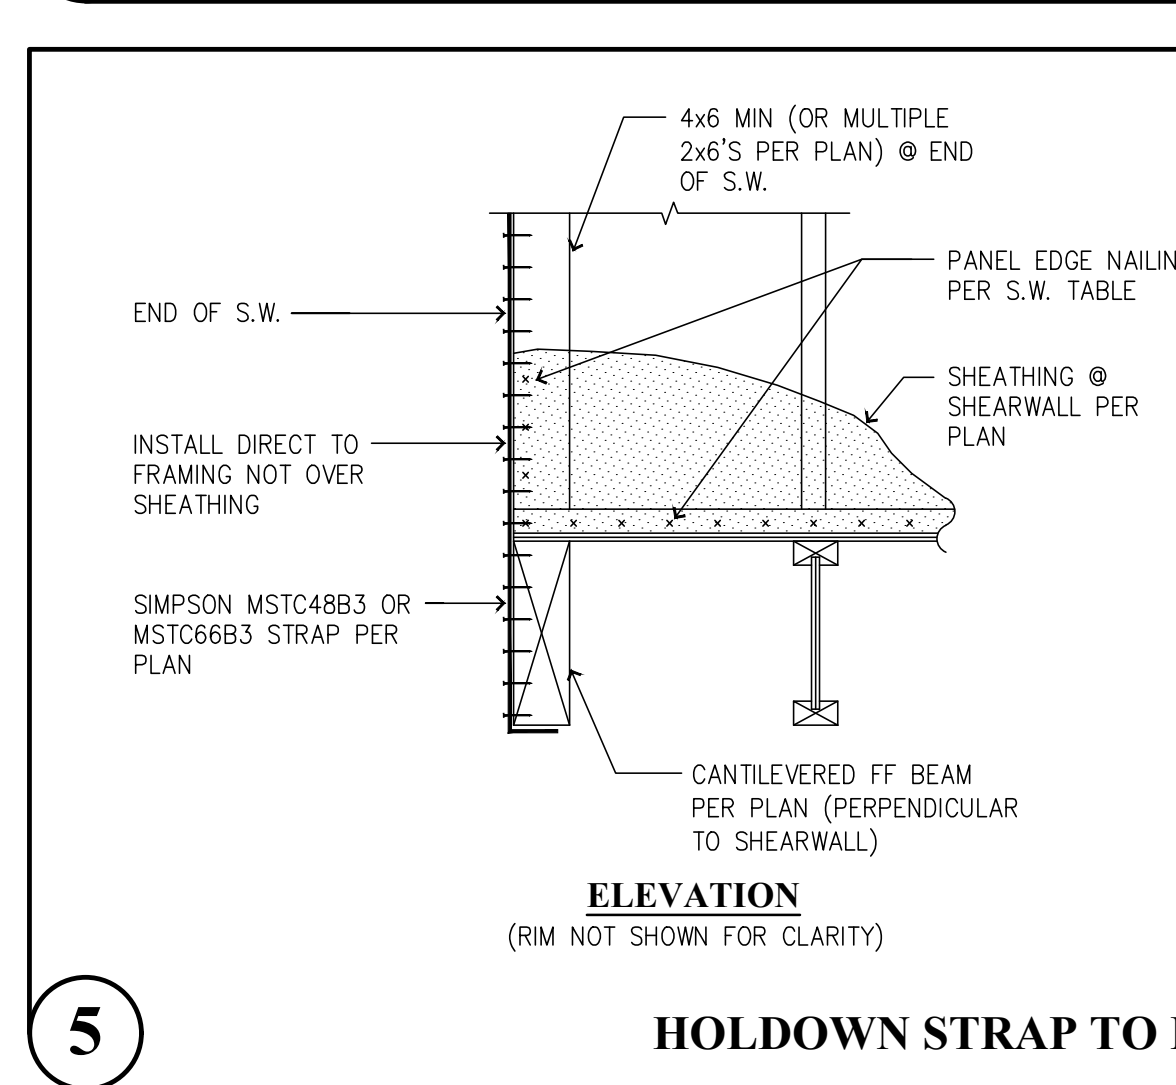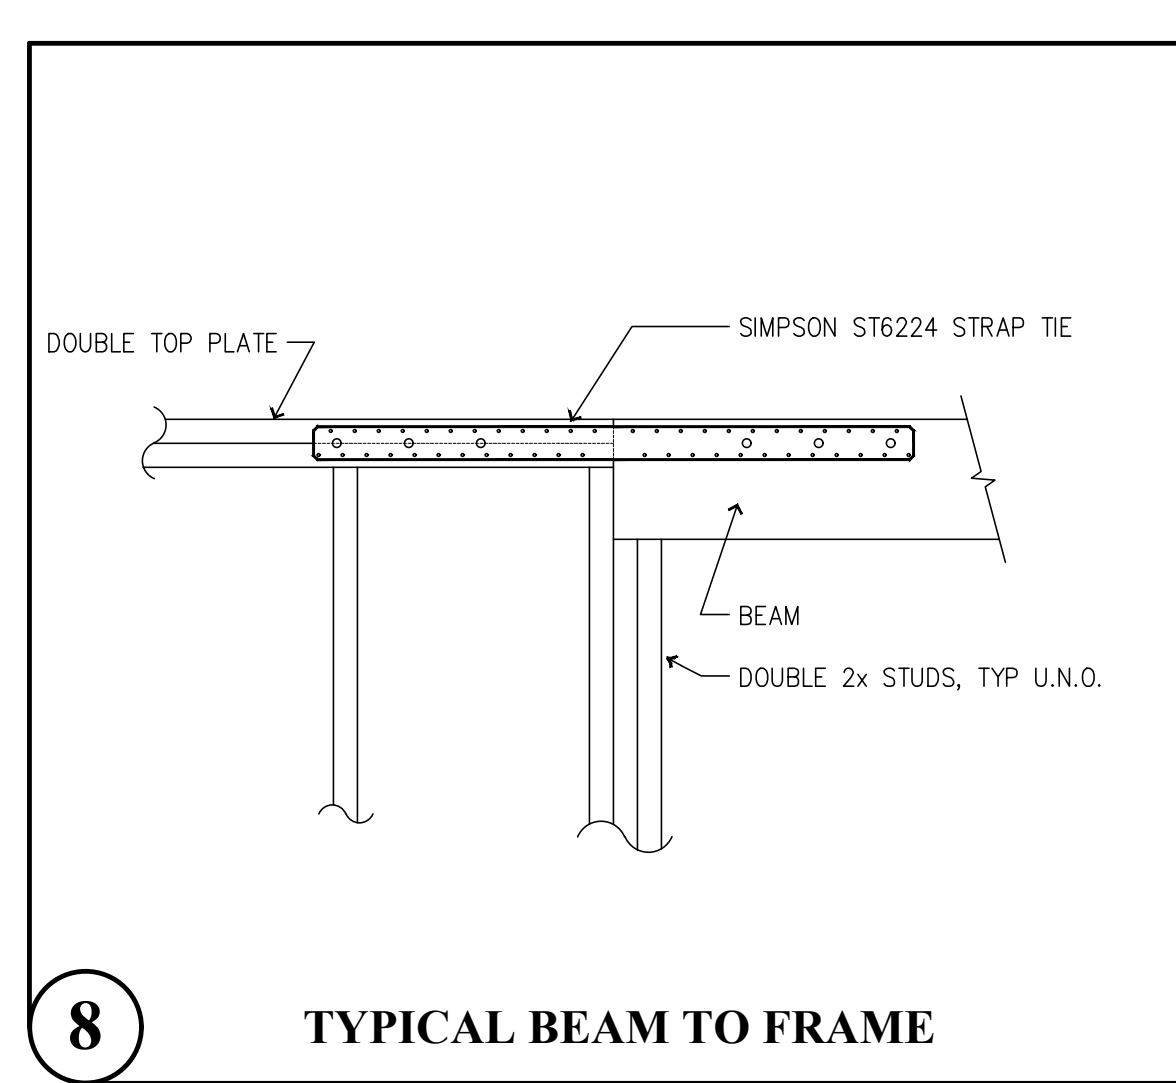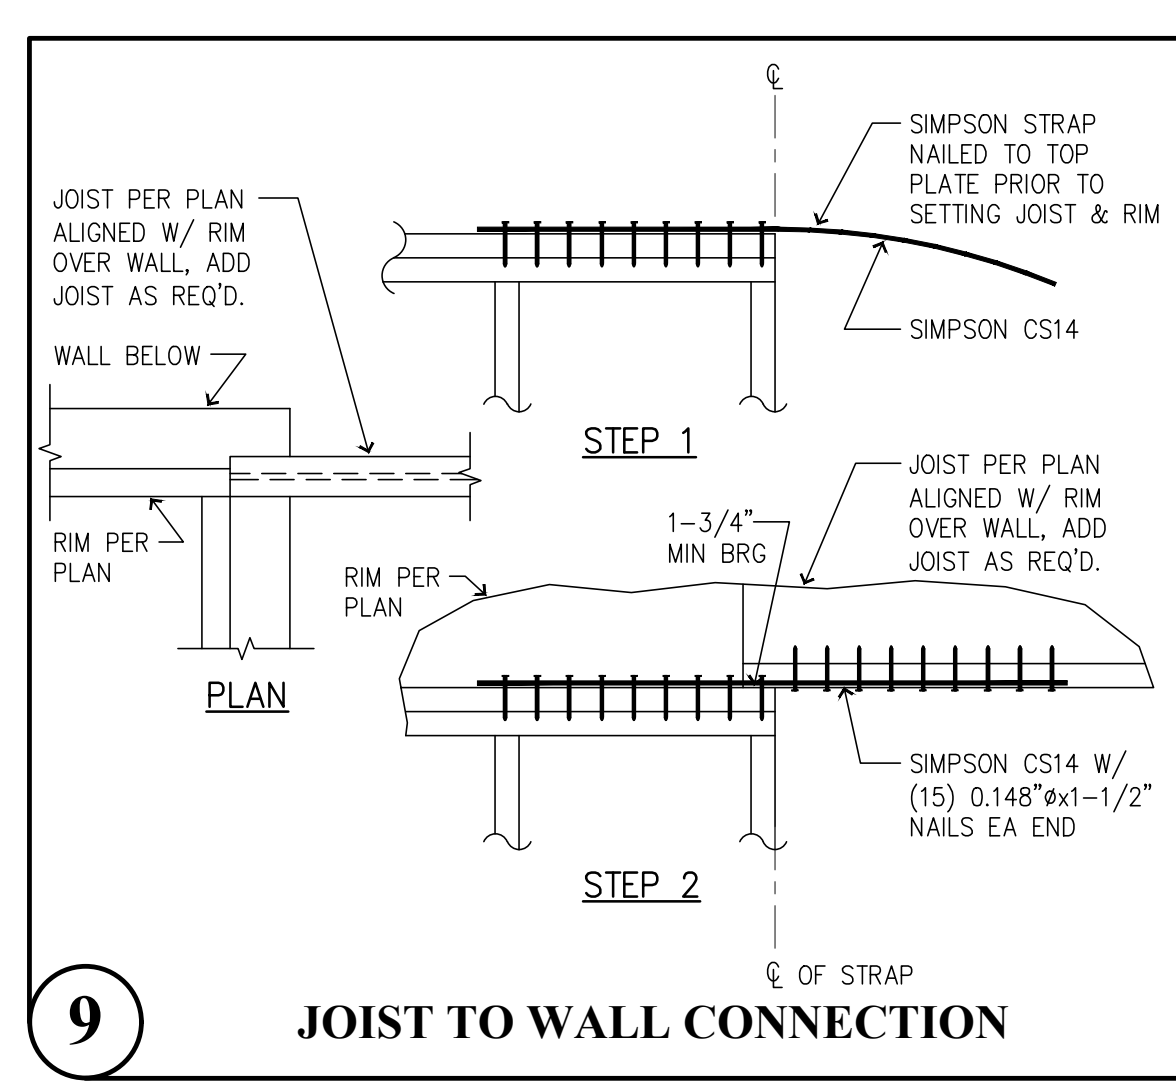

Revisions to this sheet:

Bradley Heights Apartments
 202 27th Ave SE
 Puyallup, Washington

PROJECT NO. : 23.007
 DESIGNED BY : TLC, OGG, MRO
 DRAWN BY : RSO
 ISSUE DATE : 2-20-24
 LATEST REV. OF DWG. SET :

SUBMITTAL SET ONLY NOT FOR CONSTRUCTION
 THESE DRAWINGS ARE SUBJECT TO REVISIONS PENDING LOCAL JURISDICTIONAL REVIEW.

Floor & Roof Framing Notes


- ROOF AND FLOOR JOIST LOCATIONS ARE SCHEMATICALLY SHOWN ON THE PLANS. IT IS NOT THE INTENT OF THE STRUCTURAL PLANS TO GRAPHICALLY LOCATE ALL FRAMING MEMBERS. THE ARCHITECT SHALL VERIFY THE COMPATIBILITY OF JOIST LAYOUT AND FRAMING W/ MECHANICAL, ELECTRICAL & PLUMBING AND ARCHITECTURAL PLANS. THE CONTRACTOR IS RESPONSIBLE FOR SPACING FRAMING MEMBERS AS NOTED ON THE PLANS AND GENERATING MEMBER LAYOUT FOR SHOP DRAWINGS AND QUANTITY TAKEOFFS.
- FOR ALL UNITS TYPES SEE WALL STUD SCHEDULE FOR BEARING WALL STUD REQUIREMENTS. ALL OTHER NON-BEARING 2x4 & 2x6 WALLS ARE AT 16" O.C.
- THE TRUSS AND JOIST MANUFACTURER SHALL VERIFY BEARING COMPATIBILITY (CRUSHING) WITH THE PLATE MATERIAL. TYPICALLY, COMPOSITE BEAMS SHALL BE FULLY BEARING ON 2x_ WALLS. I.E. BREAK IRM OR BLOCKING TO ALLOW FULL BEARING OVER PLATES.
- PLACE LONG DIRECTION OF ALL OSB SHEETS PERPENDICULAR TO TRUSS/RAFTER OR JOIST DIRECTION, SEE DETAIL 3/S1.2. FLOOR SHEATHING IS TO BE CONTINUOUS FROM UNIT TO UNIT. TYPICAL NAILING AT FLOOR AND ROOF DIAPHRAGMS IS PROVIDED IN THE GENERAL STRUCTURAL NOTES ON SHEETS S1.0.
- W DENOTES THE SHEARWALL TYPE, SEE THE SHEARWALL TABLE ON SHEET S1.2. INDICATES SHEARWALL LOCATION, THE CALLOUTS ON THE SHEARWALL TABLE APPLY ONLY ALONG THE LENGTH OF WALL SHOWN SHADED. PROVIDE SOLID BLOCKING IN FLOOR SPACE BELOW PERPENDICULAR SHEARWALLS. W/A INDICATES SHEAR WALL TYPE WITH OPENINGS. PROVIDE SHEATHING AROUND ALL OPENINGS AND ABOVE AND BELOW ALL OPENINGS. PROVIDE HORIZONTAL STRIPS & NAILING AT OPENINGS PER 8/S1.2
- THE DOUBLE TOP PLATE IS TO BE CONTINUOUS ALONG ALL EXTERIOR WALLS AND AT ALL WALL LINES CONTAINING SHEARWALLS. TYPICAL WALL TOP PLATE SPLICES SHALL BE PER DETAIL 7/S1.2 TYP.
- WHERE COMPOSITE JOISTS AND BEAMS ARE USED AS DRAG STRUTS THE MANUFACTURER SHALL PROVIDE THE FRAMING MEMBERS WITH THE CAPACITY CALLED OUT ON THE PLANS.
- TYPICAL FLOOR JOISTS SHALL BE 11-7/8" T&I/10 @ 16" O.C. TYP. U.N.O. THE MANUFACTURER SHALL BE RESPONSIBLE FOR ALL JOIST AND BEAM HANGERS, WEB STIFFENERS, SOLID BLOCKING, AND ADDITIONAL RM OR JOIST MATERIAL TO ACCOMMODATE FLUSH-FRAMED CONDITIONS (F.F.), CANTILEVERED CONDITIONS, CONCENTRATED BEARING LOADS AND NAILING FROM SHEARWALLS ABOVE AND BELOW.
- F.F. = FLUSH-FRAMED BEAM. VERIFY FLUSH OR DROPPED BEAM CONDITION PER ARCHITECT.
- ALL BEAMS PER SCHEDULE U.N.O. ALL NON BEARING BEAMS SHALL BE A MIN OF (2)2x8 U.N.O. ALL OTHER BEAMS ARE AS MARKED ON PLANS.
- AT ALL BEAM BEARING/JAMB LOCATIONS, AT MINIMUM PROVIDE BEARING (TRIMMER) STUDS AND FULL HEIGHT (KING) STUDS PER THE JAMB STUD SCHEDULE FOR EACH BUILDING IF PROVIDED. IF NO SCHEDULE, PROVIDE (1) 2x_ BEARING AND (1) 2x_ FULL HEIGHT STUD MINIMUM.
- EXPOSED FRAMING SHALL BE PRESSURE TREATED (P.T.) VERTICAL & HORIZONTAL FRAMING @ WATERPROOFED WALKWAYS AND PRIVATE DECKS. ALL EXPOSED BEAM HANGERS SHALL BE POST HOT-DIPPED GALVANIZED AND HAVE CONCEALED FLANGES, VERIFY W/ ARCHITECT. SEE NOTE ON SHEET S1.0
- FOR TYPICAL HOLDOWN ASSEMBLIES SEE THE HOLDOWN TABLE ON 2/S1.2 AND DETAILS ON SHEET S3.0.
- SEE ARCHITECTURAL PLANS FOR STAIR FRAMING DETAILS & STAIR FRAMING DETAILS AND NOTES, CONTROL JOINTS IN CONCRETE FLOORING AND ROOF VENTILATION REQUIREMENTS AND DETAILS.
- SEE CIVIL AND ARCHITECTURAL PLANS FOR TOP OF WALL HEIGHTS AND ELEVATIONS. SEE ARCHITECTURAL PLANS FOR DIMENSIONS, WHERE DIMENSIONS ARE SHOWN ON THE STRUCTURAL PLANS, CONTRACTOR SHALL VERIFY COMPATIBILITY W/ ARCHITECTURAL PLANS. WHERE DISCREPANCY EXISTS, CONTRACTOR SHALL NOTIFY BOTH THE ENGINEER AND ARCHITECT FOR CLARIFICATION.
- WINDOW SUPPLIER TO VERIFY THAT WINDOW AND WINDOW FRAMES TRANSFER WIND LOADS EVENLY TO STRUCTURAL FRAMING ON ALL 4 SIDES OF WINDOW. WINDOW SUPPLIER TO VERIFY MINIMUM .005"H STORY DRIFT TOLERANCE IN PLANE OF ALL WINDOWS AND ALLOW FOR L/240 DEFLECTION (PERPENDICULAR) AT WINDOW MULLIONS.
- SEE GENERAL STRUCTURAL NOTES ON S1.0 TO S1.3 FOR ADDITIONAL INFORMATION.
- LEGEND:

- INDICATES BEAM / GIRDER TRUSS PER PLAN SEE FRAMING PLANS
- INDICATES HANGER PER MANUFACTURER
- GT INDICATES GIRDER TRUSS PER PLAN
- INDICATES JOIST / TRUSS BEARING @ WALL / BEAM
- INDICATES JOIST / TRUSS INTERMEDIATE BEARING @ WALL / BEAM

INDICATES TYPICAL TOILET, BATHUB & SHOWER LAYOUT. CONTRACTOR TO COORDINATE JOIST LAYOUT WITH FIXTURE LOCATIONS TO AVOID PLUMBING & FRAMING CONFLICTS.

- INDICATES ROOF OVERFRAMING - SEE DETAILS 5/S5.0
- PROVIDE WALL FIREBLOCKING @ DROPPED SOFFITS SHOWN ON ARCH.
- PROVIDE WALL BLOCKING FOR ALL WALL MOUNTED EQUIPMENT (SUCH AS TOWEL BARS, GRAB BARS, TOILET PAPER HOLDERS, DOOR STOPS, ETC.).
- LFA INDICATES - LOAD FROM ABOVE
- FF INDICATES FLUSH FRAMED BEAM
- INDICATES STRAP HOLDOWN, SEE SHEET 2/S1.2 FOR HOLDOWN TABLE & UPPER TO LOWER WALL STRAP/HOLDOWN KEY.
- REFER TO ARCHITECTURAL DRAWINGS FOR ALL FLOOR ELEVATIONS.
- SIMPSON STRONG PRODUCTS ARE CALLED OUT ON THE DRAWINGS, HOWEVER, EITHER SIMPSON OR KC METALS PRODUCTS MAY BE USED PROVIDED IT HAS SAME OR GREATER CAPACITY.

NOTE:
ALL JOISTS ARE 11-7/8" T&I/10 @ 16" O.C. TYPICAL U.N.O. USE FACE MOUNT HANGER @ F.F. COND. U.N.O.
NOTE:
P.T. 2x8 JOISTS @ 16" O.C. TYP. U.N.O. @ DECKS
P.T. 2x10 JOISTS @ 16" O.C. TYP. U.N.O. @ STAIR LANDINGS

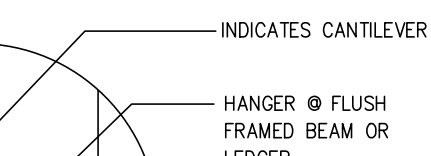

Framing Key

SEE SHEET S1.2 FOR SHEARWALL AND HOLDOWN TABLES

Beam Schedule

MARK	BEAM SIZE
B1	4x8
B2	4x10
B3	6x10 DF #2
B4	3-1/8 x 10-1/2 GLB
B5	P.T. 4x8
B6	P.T. 4x10
B7	P.T. 6x10 HF #1
B8	P.T. 3-1/8 x 10-1/2 GLB
B9	P.T. 5-1/8 x 10-1/2 GLB
B10	5-1/4x11-7/8 PSL
B11	3-1/2x11-7/8 LSL

Jamb Stud Schedule

TYPE	C1	C2	C3	C4	C5	C6	-	-
BEARING/FULL HT STUDS	1/2	1/3	2/1	2/2	2/3	2/4	-	-

NOTE: STUD SIZE SHOULD MATCH WALL SIZE PER PLAN.

Wall Stud Schedule

FRAMING LEVEL	2x6 EXTERIOR	2x6 BRG INT SINGLE WALL	2x4 BRG INT PARTY WALLS	2x4 BRG SINGLE WALL	2x4 BRG PARTY WALLS
ROOF	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x4 HF#2 @ 16" O.C.	2x4 HF#2 @ 16" O.C.	2x4 HF#2 @ 16" O.C.
3RD	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x4 HF#2 @ 16" O.C.	2x4 HF#2 @ 16" O.C.	2x4 HF#2 @ 16" O.C.
2ND	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x4 HF#2 @ 16" O.C.	2x4 HF#2 @ 16" O.C.	2x4 HF#2 @ 16" O.C.
BASEMENT	2x6 @ 16" O.C.	2x6 @ 12" O.C.	2x4 HF#2 @ 12" O.C.	2x4 HF#2 @ 12" O.C.	2x4 HF#2 @ 12" O.C.


- NOTES:**
- ALL STUD MATERIAL SHALL BE HEM FIR STUD GRADE OR BETTER UNLESS NOTED OTHERWISE AND PLATE MATERIAL SHALL BE HEM FIR STANDARD OR BETTER UNLESS NOTED OTHERWISE. STUDS CALLED OUT IN THIS SCHEDULE ARE FOR WALL SUPPORTING THE FRAMING LEVEL INDICATED. THAT IS WALLS BELOW THE FRAMING LEVEL SHOWN.
 - THIS SCHEDULE COVERS BUILDING UNITS 3 STORES IN HEIGHT. FIRST, DETERMINE THE NUMBER OF STORES FOR THE UNIT, SECOND, DETERMINE THE FRAMING LEVEL, THIRD, READ SCHEDULE HORIZONTALLY FOR THE WALL LOCATION.

Foundation Notes

- TYPICAL DIMENSIONS ARE TO FACE OF WALL OR TO CENTERLINE OF COLUMN OR FOOTING. VERIFY ALL DIMENSIONS & ELEVATIONS WITH THE ARCHITECT.
- PROVIDE FOOTING SUBSTRATE PREPARATION PER THE SOILS REPORT.
- F.-. INDICATES ISOLATED FOOTING TYPICAL ISOLATED FTG SHALL BE CONSTRUCTED PER FOOTING SCHEDULE 5/S3.0.
- EXTEND ALL CONTINUOUS FOOTINGS AT END WALLS 1'-0" MIN BEYOND END OF ALL BEARING WALLS & SHEARWALLS. (TYPICAL) UNO
- ALL EXTERIOR WALLS SHALL HAVE AN 8" STEMWALL AND A 18" WIDE x 8" DEEP FOOTING W/ STEEL REINFORCING 3" CLR. OF SOIL UNLESS NOTED OTHERWISE
- ADD STRIP DRAINS AT FACE OF BUILDINGS WHEN WALKS SLOPE TOWARD BUILDING, CONNECT TO TIGHTLINE.
- PROVIDE #4-24" x 24" CORNER BARS TO MATCH ALL HORIZONTAL REINFORCEMENT IN STEMWALLS AND FOOTINGS. (TYPICAL)
- FLOOR SLABS - 4" CONC. SLAB ON GRADE 6x6 @ W1.2/W1.2 WWF @ CENTER-LINE OR FIBER MESH PER MANUFACTURER OVER SUBSTRATE PER SOILS ENGINEER, USE WWF WHERE INDICATED. PROVIDE CONTROL JOINTS PER DETAIL 15/S3.0 AT THE DIRECTION OF THE ARCHITECT.
- ENTRY SLABS - 4" CONC. SLAB (BROOM FINISH)
- PATIO SLABS - 4" CONC. W/ THICKENED EDGES. SLOPE AWAY FROM BUILDING AT 1/4"/FT. SEE 3/S3.0
- ALL THICKENED SLABS FOR BEARING WALLS AND PARTY WALLS SHALL BE 18" WIDE x 12" DEEP W/ (2) #4 BARS CONTINUOUS UNLESS NOTED OTHERWISE. DEEPEN LOCALLY AT HOLDOWNS TO OBTAIN EMBEDMENT DEPTH + 3" MIN.
- ALL THICKENED EDGE SLABS SHALL BE 8" WIDE x 8" DEEP W/ (1) #4 BAR CONTINUOUS (3" FROM BOTTOM) UNLESS NOTED OTHERWISE. SEE 3/S3.0.
- W/A DENOTES THE SHEARWALL TYPE, SEE THE SHEARWALL TABLE ON SHEET S1.2. INDICATES SHEARWALL LOCATION, THE CALLOUTS ON THE SHEARWALL TABLE APPLY ONLY ALONG THE LENGTH OF WALL SHOWN SHADED. PROVIDE SOLID BLOCKING IN FLOOR SPACE BELOW PERPENDICULAR SHEARWALLS. W/A INDICATES SHEAR WALL TYPE WITH OPENINGS. PROVIDE SHEATHING AROUND ALL OPENINGS AND ABOVE AND BELOW ALL OPENINGS. PROVIDE HORIZONTAL STRIPS & NAILING AT OPENINGS PER 8/S1.2
- INDICATES HOLDOWN, SEE 2/S1.2 FOR HOLDOWN TABLE & UPPER TO LOWER WALL STRIPS HOLDOWN/KEY.
- VERIFY ALL TOP OF SLAB ELEVATIONS AND BUILDING STEPS WITH ARCH/CIVIL PLANS TYPICAL.
- TYPICAL PERIMETER FOOTING SHALL BE LOCATED A MIN. 18" BELOW GRADE OR AS REQUIRED BY LOCAL JURISDICTION.
- SEE DETAILS FOR TYPICAL STEMWALL/FOOTING & THICKENED SLAB CONSTRUCTION.
- T.O.W. = TOP OF STEMWALL
T.O.F. = TOP OF FOOTING
T.O.S. = TOP OF SLAB
- SEE THE GENERAL STRUCTURAL NOTES ON SHEET S1.0 FOR ADDITIONAL INFORMATION.
- VERIFY WITH CIVIL GRADING PLAN FOR GARAGE SLAB ELEVATION @ GARAGE DOORWAY.
- DEEPEEN FOOTINGS AS NECESSARY TO MAINTAIN MINIMUM COVER. COORDINATE WITH CIVIL GRADING PLAN FOR GRADE CONDITIONS.
- INDICATES DEPRESSED TOP OF STEMWALL AT DOORWAY. POUR SLAB OVER SEE 4/S3.0.
- ALL INTERSECTING FOOTINGS / STEMWALLS SHALL HAVE CORNER BARS TO MATCH HORIZ REINFORCEMENT SEE 10/S3.0

Continuous Wall Footing Schedule


"W"	"D"	REINFORCEMENT	
		LONGITUDINAL	TRANSVERSE
1'-6"	12"	(2)-#4 BOT	-
2'-0"	12"	(3)-#4 BOT	-
3'-0"	14"	(3)-#5 BOT	#4 @ 18" O.C. BOT

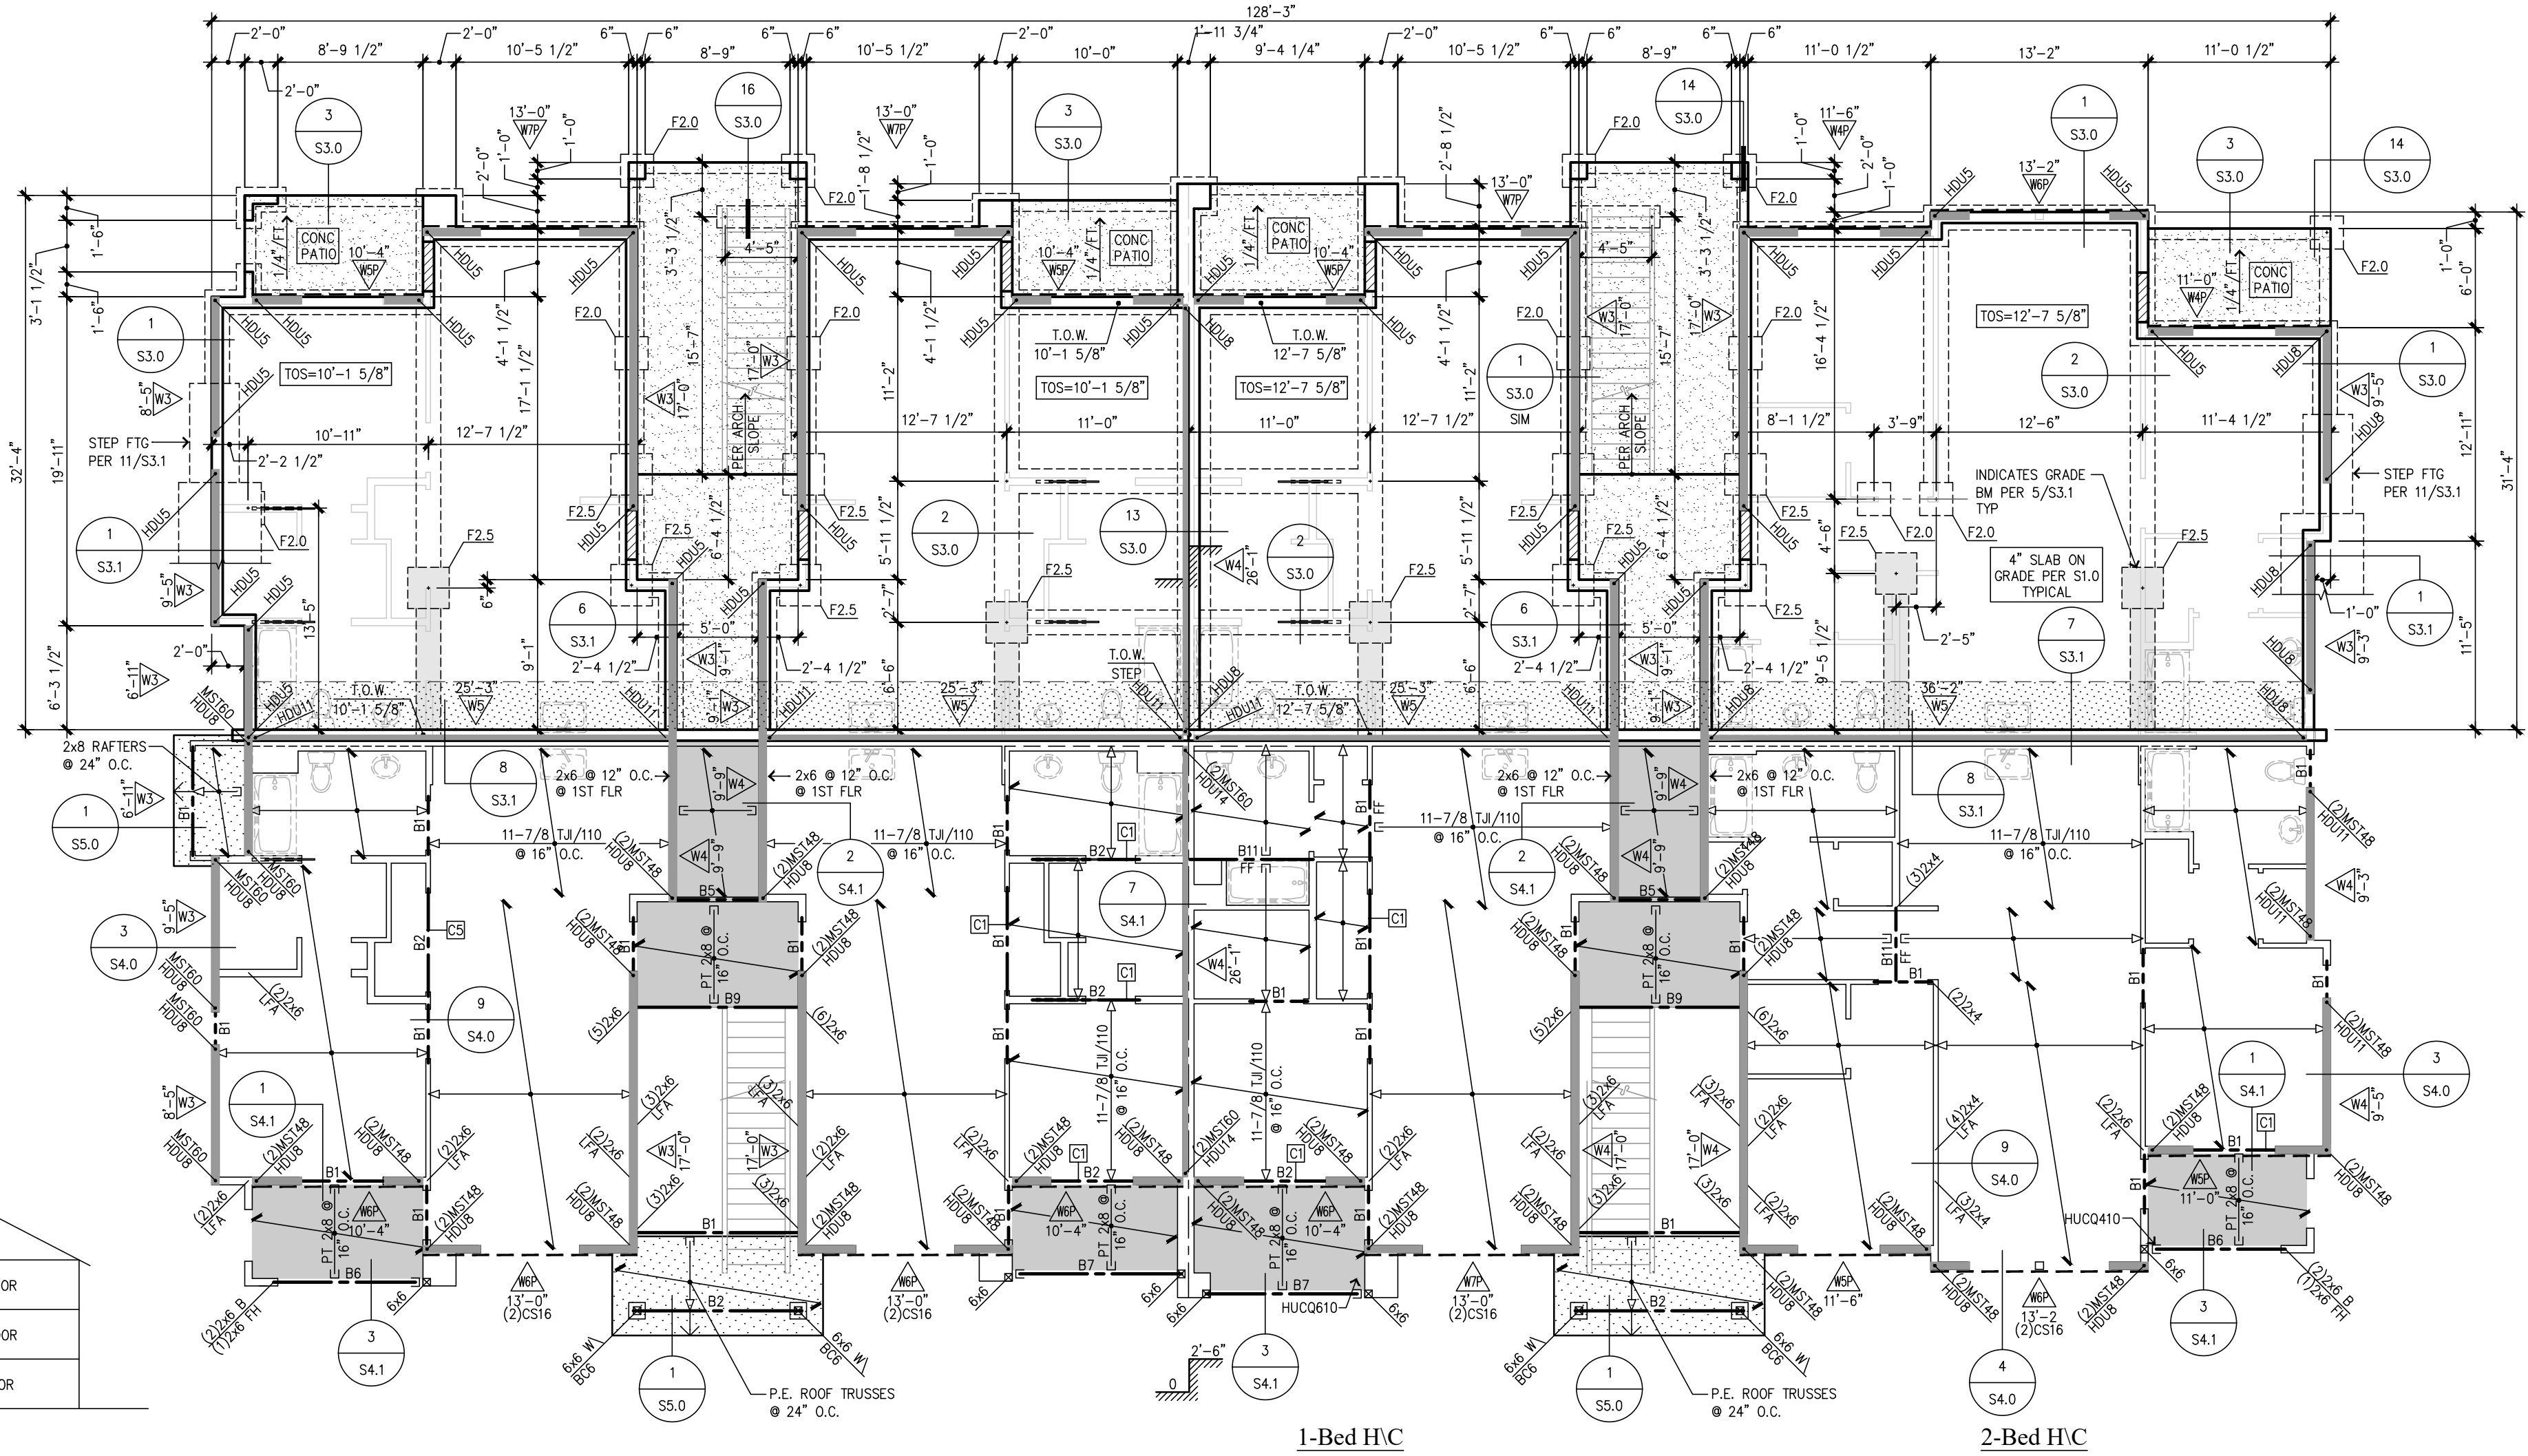

Foundation / Basement Floor Framing Plan - Bldg A

SCALE 1/8"=1'-0"

3/4 Bldg Split Key

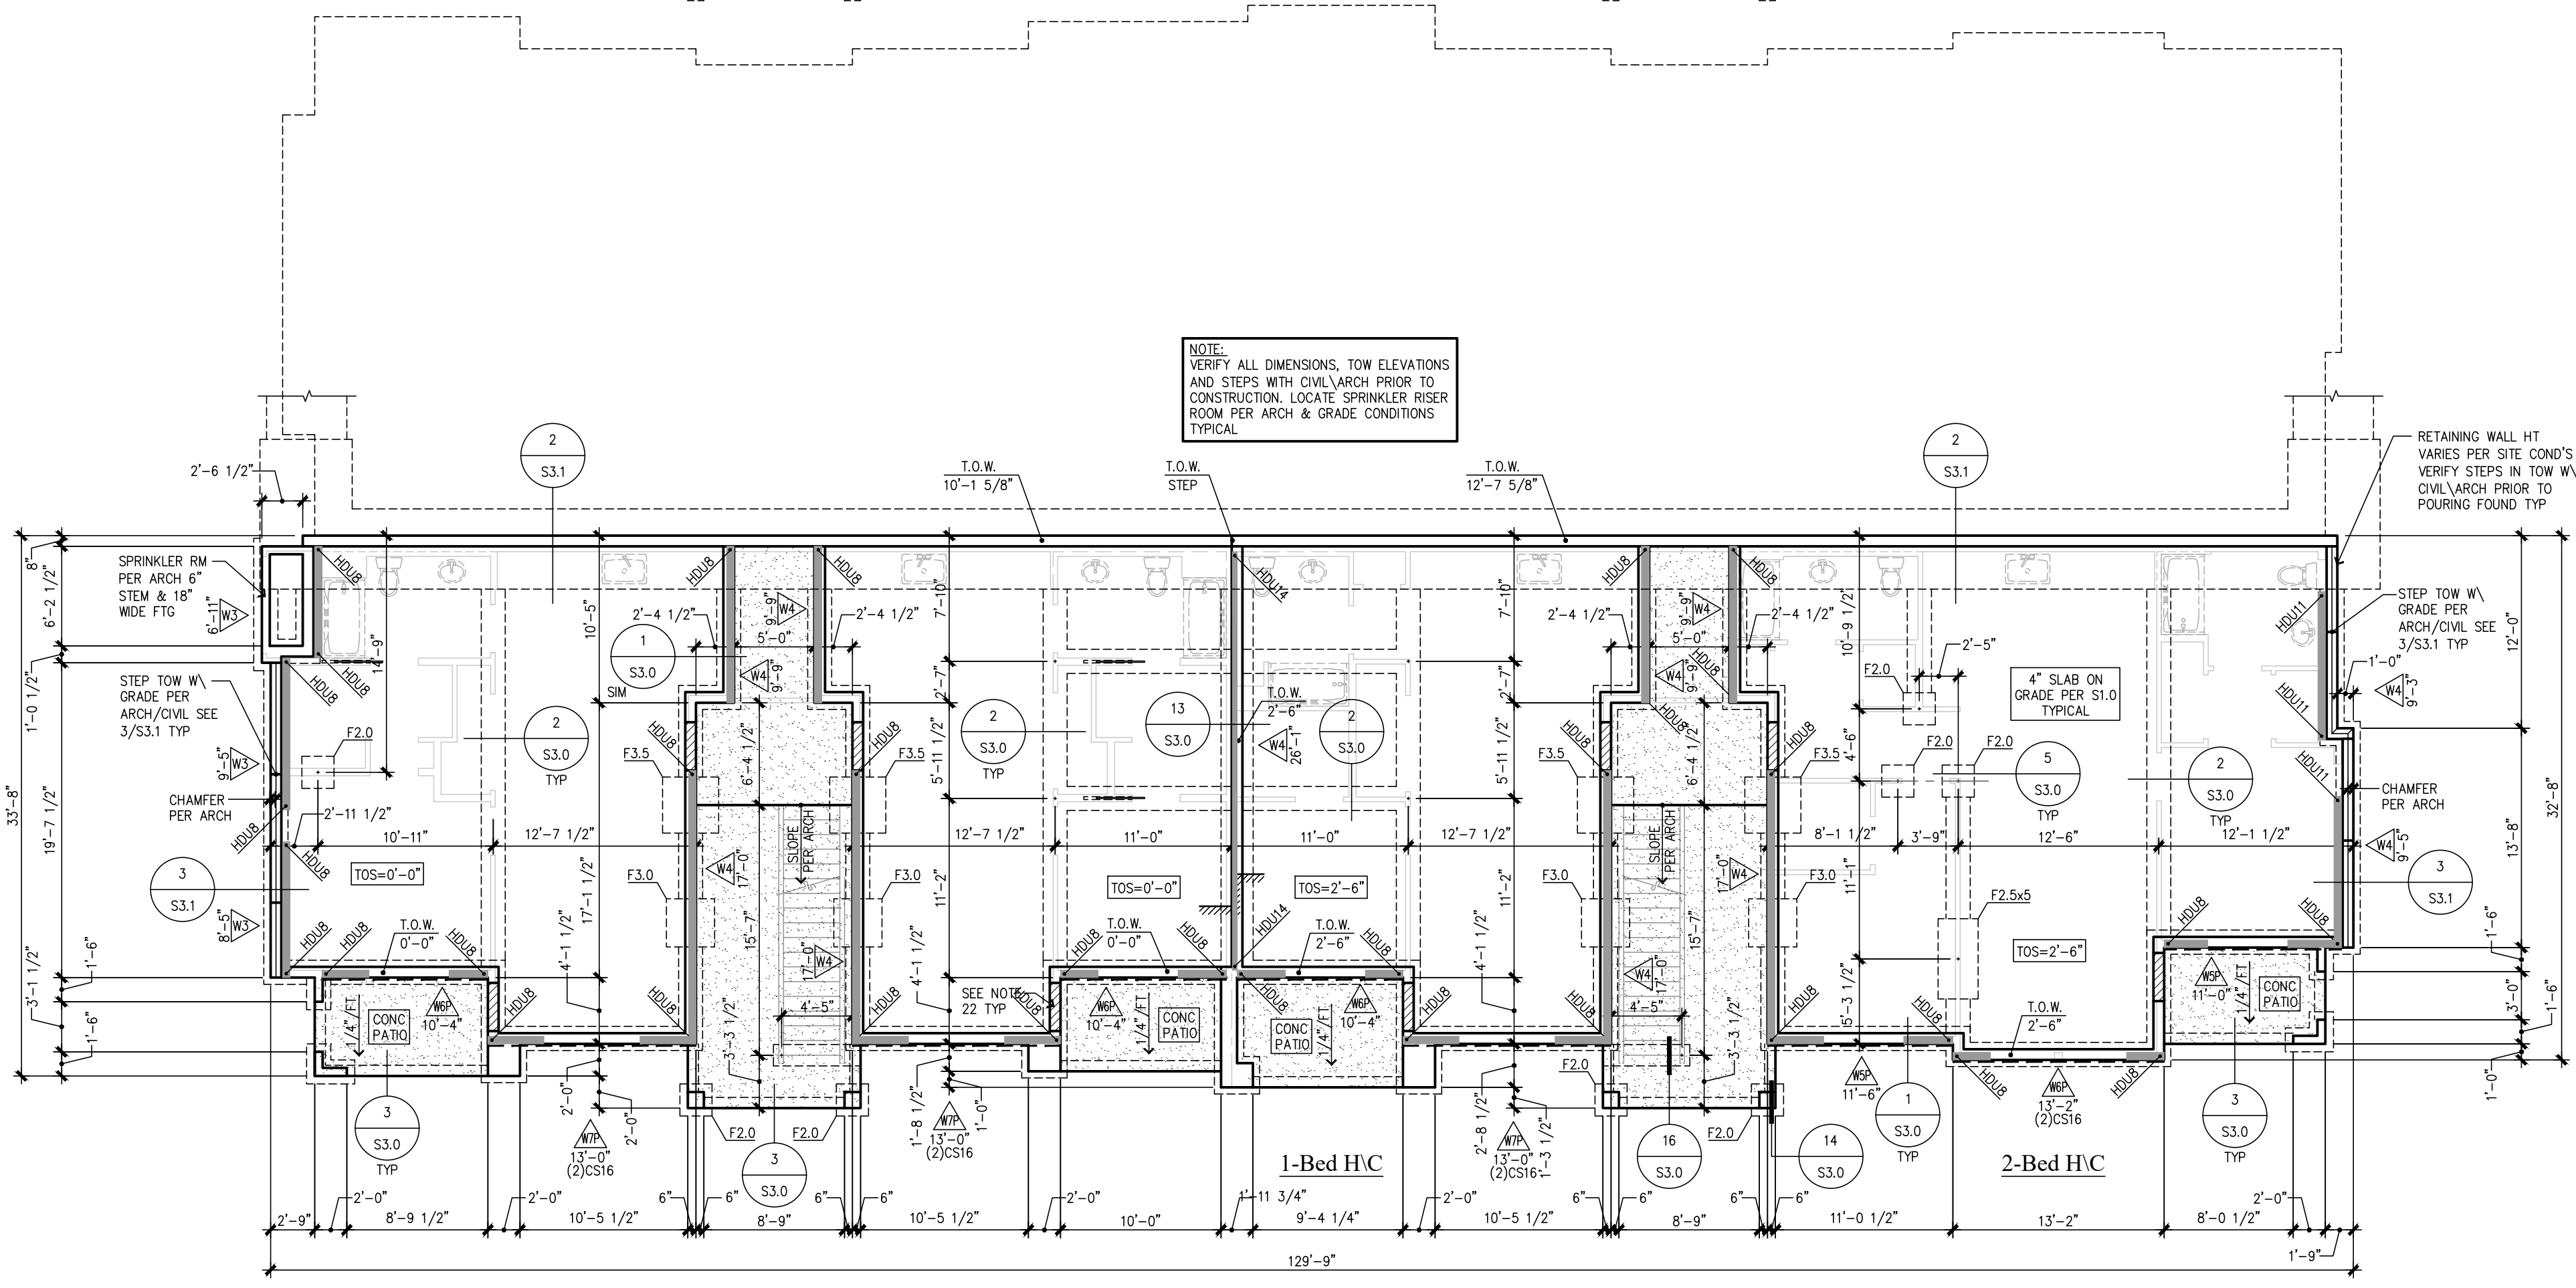

Foundation Plan Basement - Bldg A

SCALE 1/8"=1'-0"

Revisions to this sheet:

Bradley Heights Apartments
202 27th Ave SE
Puyallup, Washington

Solutions 4 Structures
A Structural Engineering Corporation


PROJECT NO. : 23-007
DESIGNED BY : TLC, OGG, MRO
DRAWN BY : RSO
ISSUE DATE : 2-20-24
LATEST REV. OF DWG. SET :

Payallup, Washington 98374
Ph 253-314-9822
www.solutions4structures.com

SUBMITTAL SET ONLY NOT FOR CONSTRUCTION
THESE DRAWINGS ARE SUBJECT TO REVISIONS PENDING LOCAL JURISDICTIONAL REVIEW.

S2.0

CAD FILE: F:\Projects\2023 Projects\Drawings\S2.0.dwg PLOT DATE/TIME: 2/15/2024 - 9:25am THANK YOU FOR USING SOLUTIONS 4 STRUCTURES

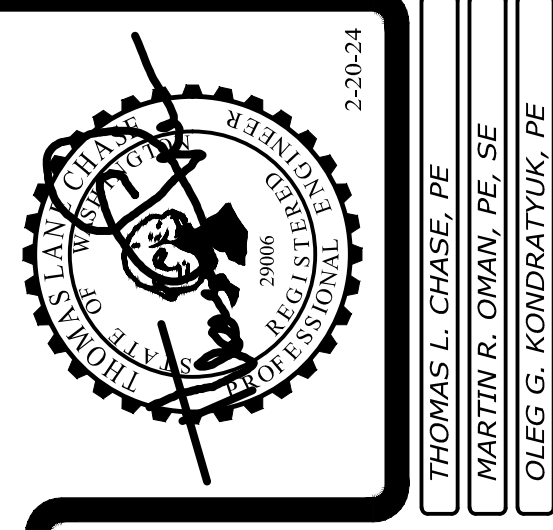

Floor & Roof Framing Notes

- ROOF AND FLOOR JOIST LOCATIONS ARE SCHEMATICALLY SHOWN ON THE PLANS. IT IS NOT THE INTENT OF THE STRUCTURAL PLANS TO GRAPHICALLY LOCATE ALL FRAMING MEMBERS. THE ARCHITECT SHALL VERIFY THE COMPATIBILITY OF JOIST LAYOUT AND FRAMING W/ MECHANICAL, ELECTRICAL & PLUMBING AND ARCHITECTURAL PLANS. THE CONTRACTOR IS RESPONSIBLE FOR SPACING FRAMING MEMBERS AS NOTED ON THE PLANS AND GENERATING MEMBER LAYOUT FOR SHOP DRAWINGS AND QUANTITY TAKEOFFS.
- FOR ALL UNITS TYPES SEE WALL STUD SCHEDULE FOR BEARING WALL STUD REQUIREMENTS. ALL OTHER NON-BEARING 2x4 & 2x6 WALLS ARE AT 16" O.C.
- THE TRUSS AND JOIST MANUFACTURER SHALL VERIFY BEARING COMPATIBILITY (CRUSHING) WITH THE PLATE MATERIAL. TYPICALLY, COMPOSITE BEAMS SHALL BE FULLY BEARING ON 2x_ WALLS. I.E. BREAK RIM OR BLOCKING TO ALLOW FULL BEARING OVER PLATES.
- PLACE LONG DIRECTION OF ALL OSB SHEETS PERPENDICULAR TO TRUSS/RAFTER OR JOIST DIRECTION, SEE DETAIL 3/S1.2. FLOOR SHEATHING IS TO BE CONTINUOUS FROM UNIT TO UNIT. TYPICAL NAILING AT FLOOR AND ROOF DIAPHRAGMS IS PROVIDED IN THE GENERAL STRUCTURAL NOTES ON SHEETS S1.0.
- INDICATES THE SHEARWALL TYPE, SEE THE SHEARWALL TABLE ON SHEET S1.2
 - INDICATES SHEARWALL LOCATION, THE CALLOUTS ON THE SHEARWALL TABLE APPLY ONLY ALONG THE LENGTH OF WALL SHOWN SHADDED. PROVIDE SOLID BLOCKING IN FLOOR SPACE BELOW PERPENDICULAR SHEARWALLS.
 - INDICATES SHEAR WALL TYPE WITH OPENINGS. PROVIDE SHEATHING AROUND ALL OPENINGS AND ABOVE AND BELOW ALL OPENINGS. PROVIDE HORIZONTAL STRIPS & NAILING AT OPENINGS PER 8/S1.2
- THE DOUBLE TOP PLATE IS TO BE CONTINUOUS ALONG ALL EXTERIOR WALLS AND AT ALL WALL LINES CONTAINING SHEARWALLS. TYPICAL WALL TOP PLATE SPLICES SHALL BE PER DETAIL 7/S1.2 TYP.
- WHERE COMPOSITE JOISTS AND BEAMS ARE USED AS DRAG STRUTS THE MANUFACTURER SHALL PROVIDE THE FRAMING MEMBERS WITH THE CAPACITY CALLED OUT ON THE PLANS.
- TYPICAL FLOOR JOISTS SHALL BE 11-7/8" T&I/10 @ 16" O.C. TYP. U.N.O. THE MANUFACTURER SHALL BE RESPONSIBLE FOR ALL JOIST AND BEAM HANGERS, WEB STIFFENERS, SOLID BLOCKING, AND ADDITIONAL RIM OR JOIST MATERIAL TO ACCOMMODATE FLUSH-FRAMED CONDITIONS (F.F.), CANTILEVERED CONDITIONS, CONCENTRATED BEARING LOADS AND NAILING FROM SHEARWALLS ABOVE AND BELOW.
- F.F. = FLUSH-FRAMED BEAM. VERIFY FLUSH OR DROPPED BEAM CONDITION PER ARCHITECT.
- ALL BEAMS PER SCHEDULE U.N.O. ALL NON BEARING BEAMS SHALL BE A MIN OF (2)2x8 U.N.O. ALL OTHER BEAMS ARE AS MARKED ON PLANS.
- AT ALL BEAM BEARING/JAMB LOCATIONS, AT MINIMUM PROVIDE BEARING (TRIMMER) STUDS AND FULL HEIGHT (VINO) STUDS PER THE JAMB STUD SCHEDULE FOR EACH BUILDING IF PROVIDED. IF NO SCHEDULE, PROVIDE (1) 2x_ BEARING AND (1) 2x_ FULL HEIGHT STUD MINIMUM.
- EXPOSED FRAMING SHALL BE PRESSURE TREATED (P.T.) VERTICAL & HORIZONTAL FRAMING @ WATERPROOFED WALKWAYS AND PRIVATE DECKS. ALL EXPOSED BEAM HANGERS SHALL BE POST HOT-DIPPED GALVANIZED AND HAVE CONCEALED FLANGES, VERIFY W/ ARCHITECT. SEE NOTE ON SHEET S1.0
- FOR TYPICAL HOLDOWN ASSEMBLIES SEE THE HOLDOWN TABLE ON 2/S1.2 AND DETAILS ON SHEET S3.0.
- SEE ARCHITECTURAL PLANS FOR STAIR FRAMING DETAILS & STAIR FRAMING DETAILS AND NOTES. CONTROL JOINTS IN CONCRETE FLOORING AND ROOF VENTILATION REQUIREMENTS AND DETAILS.
- SEE CIVIL AND ARCHITECTURAL PLANS FOR TOP OF WALL HEIGHTS AND ELEVATIONS. SEE ARCHITECTURAL PLANS FOR DIMENSIONS. WHERE DIMENSIONS ARE SHOWN ON THE STRUCTURAL PLANS, CONTRACTOR SHALL VERIFY COMPATIBILITY W/ ARCHITECTURAL PLANS. WHERE DISCREPANCY EXISTS, CONTRACTOR SHALL NOTIFY BOTH THE ENGINEER AND ARCHITECT FOR CLARIFICATION.
- WINDOW SUPPLIER TO VERIFY THAT WINDOW AND WINDOW FRAMES TRANSFER WIND LOADS EVENLY TO STRUCTURAL FRAMING ON ALL 4 SIDES OF WINDOW. WINDOW SUPPLIER TO VERIFY MINIMUM .005H STORY DRIFT TOLERANCE IN PLANE OF ALL WINDOWS AND ALLOW FOR L/240 DEFLECTION (PERPENDICULAR) AT WINDOW MULLIONS.
- SEE GENERAL STRUCTURAL NOTES ON S1.0 TO S1.3 FOR ADDITIONAL INFORMATION.
- LEGEND:
 - INDICATES BEAM / GIRDER TRUSS PER PLAN SEE FRAMING PLANS
 - INDICATES HANGER PER MANUFACTURER
 - INDICATES GIRDER TRUSS PER PLAN
 - INDICATES JOIST / TRUSS BEARING @ WALL / BEAM
 - INDICATES JOIST / TRUSS INTERMEDIATE BEARING @ WALL / BEAM
 - INDICATES TYPICAL TOILET, BATHTUB & SHOWER LAYOUT. CONTRACTOR TO COORDINATE JOIST LAYOUT WITH FIXTURE LOCATIONS TO AVOID PLUMBING & FRAMING CONFLICTS.
 - INDICATES ROOF OVERFRAMING - SEE DETAILS 5/S5.0
- PROVIDE WALL FIREBLOCKING @ DROPPED SOFFITS SHOWN ON ARCH.
- PROVIDE WALL BLOCKING FOR ALL WALL MOUNTED EQUIPMENT (SUCH AS TOWEL BARS, GRAB BARS, TOILET PAPER HOLDERS, DOOR STOPS, ETC.).
- LFA INDICATES - LOAD FROM ABOVE
- FF INDICATES FLUSH FRAMED BEAM
- INDICATES STRAP HOLDOWN, SEE SHEET 2/S1.2 FOR HOLDOWN TABLE & UPPER TO LOWER WALL STRAP/HOLDOWN KEY.
- REFER TO ARCHITECTURAL DRAWINGS FOR ALL FLOOR ELEVATIONS.
- SIMPSON STRONG IRON PRODUCTS ARE CALLED OUT ON THE DRAWINGS, HOWEVER, EITHER SIMPSON OR KC METALS PRODUCTS MAY BE USED PROVIDED IT HAS SAME OR GREATER CAPACITY.

SEE SHEET S1.2 FOR SHEARWALL AND HOLDOWN TABLES

Beam Schedule	
MARK	BEAM SIZE
B1	4x8
B2	4x10
B3	6x10 DF #2
B4	3-1/8 x 10-1/2 GLB
B5	P.T. 4x8
B6	P.T. 4x10
B7	P.T. 6x10 HF #1
B8	P.T. 3-1/8 x 10-1/2 GLB
B9	P.T. 5-1/8 x 10-1/2 GLB
B10	5-1/4x11-7/8 PSL
B11	3-1/2x11-7/8 LSL


Jamb Stud Schedule								
TYPE	CT	C2	C3	C4	C5	C6	-	-
BEARING/FULL HT STUDS	1/2	1/3	2/1	2/2	2/3	2/4	-	-

NOTE: STUD SIZE SHOULD MATCH WALL SIZE PER PLAN.


Wall Stud Schedule					
FRAMING LEVEL	2x6 EXTERIOR	2x6 BRG INT SINGLE WALL	2x6 BRG INT PARTY WALLS	2x4 BRG SINGLE WALL	2x4 BRG PARTY WALLS
ROOF	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x4 HF #2 @ 16" O.C.	2x4 HF #2 @ 16" O.C.
3RD	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x4 HF #2 @ 16" O.C.	2x4 HF #2 @ 16" O.C.
2ND	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x6 @ 16" O.C.	(2)2x4 HF #2 @ 16" O.C.	2x4 HF #2 @ 16" O.C.
BASEMENT	2x6 @ 16" O.C.	2x6 @ 12" O.C.	2x6 @ 16" O.C.	(2)2x4 HF #2 @ 12" O.C.	2x4 HF #2 @ 16" O.C.

NOTES:

- ALL STUD MATERIAL SHALL BE HEM FIR STUD GRADE OR BETTER UNLESS NOTED OTHERWISE AND PLATE MATERIAL SHALL BE HEM FIR STANDARD OR BETTER UNLESS NOTED OTHERWISE.
- STUDS CALLED OUT IN THIS SCHEDULE ARE FOR WALL SUPPORTING THE FRAMING LEVEL INDICATED, THAT IS WALLS BELOW THE FRAMING LEVEL SHOWN.
- THIS SCHEDULE COVERS BUILDING UNITS 3 STORES IN HEIGHT. FIRST, DETERMINE THE NUMBER OF STORES FOR THE UNIT, SECOND, DETERMINE THE FRAMING LEVEL, THIRD, READ SCHEDULE HORIZONTALLY FOR THE WALL LOCATION.

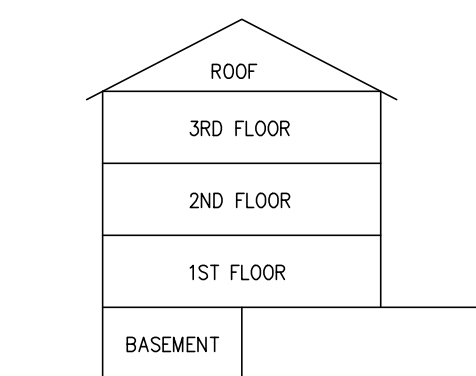


3/4 Bldg Split Key

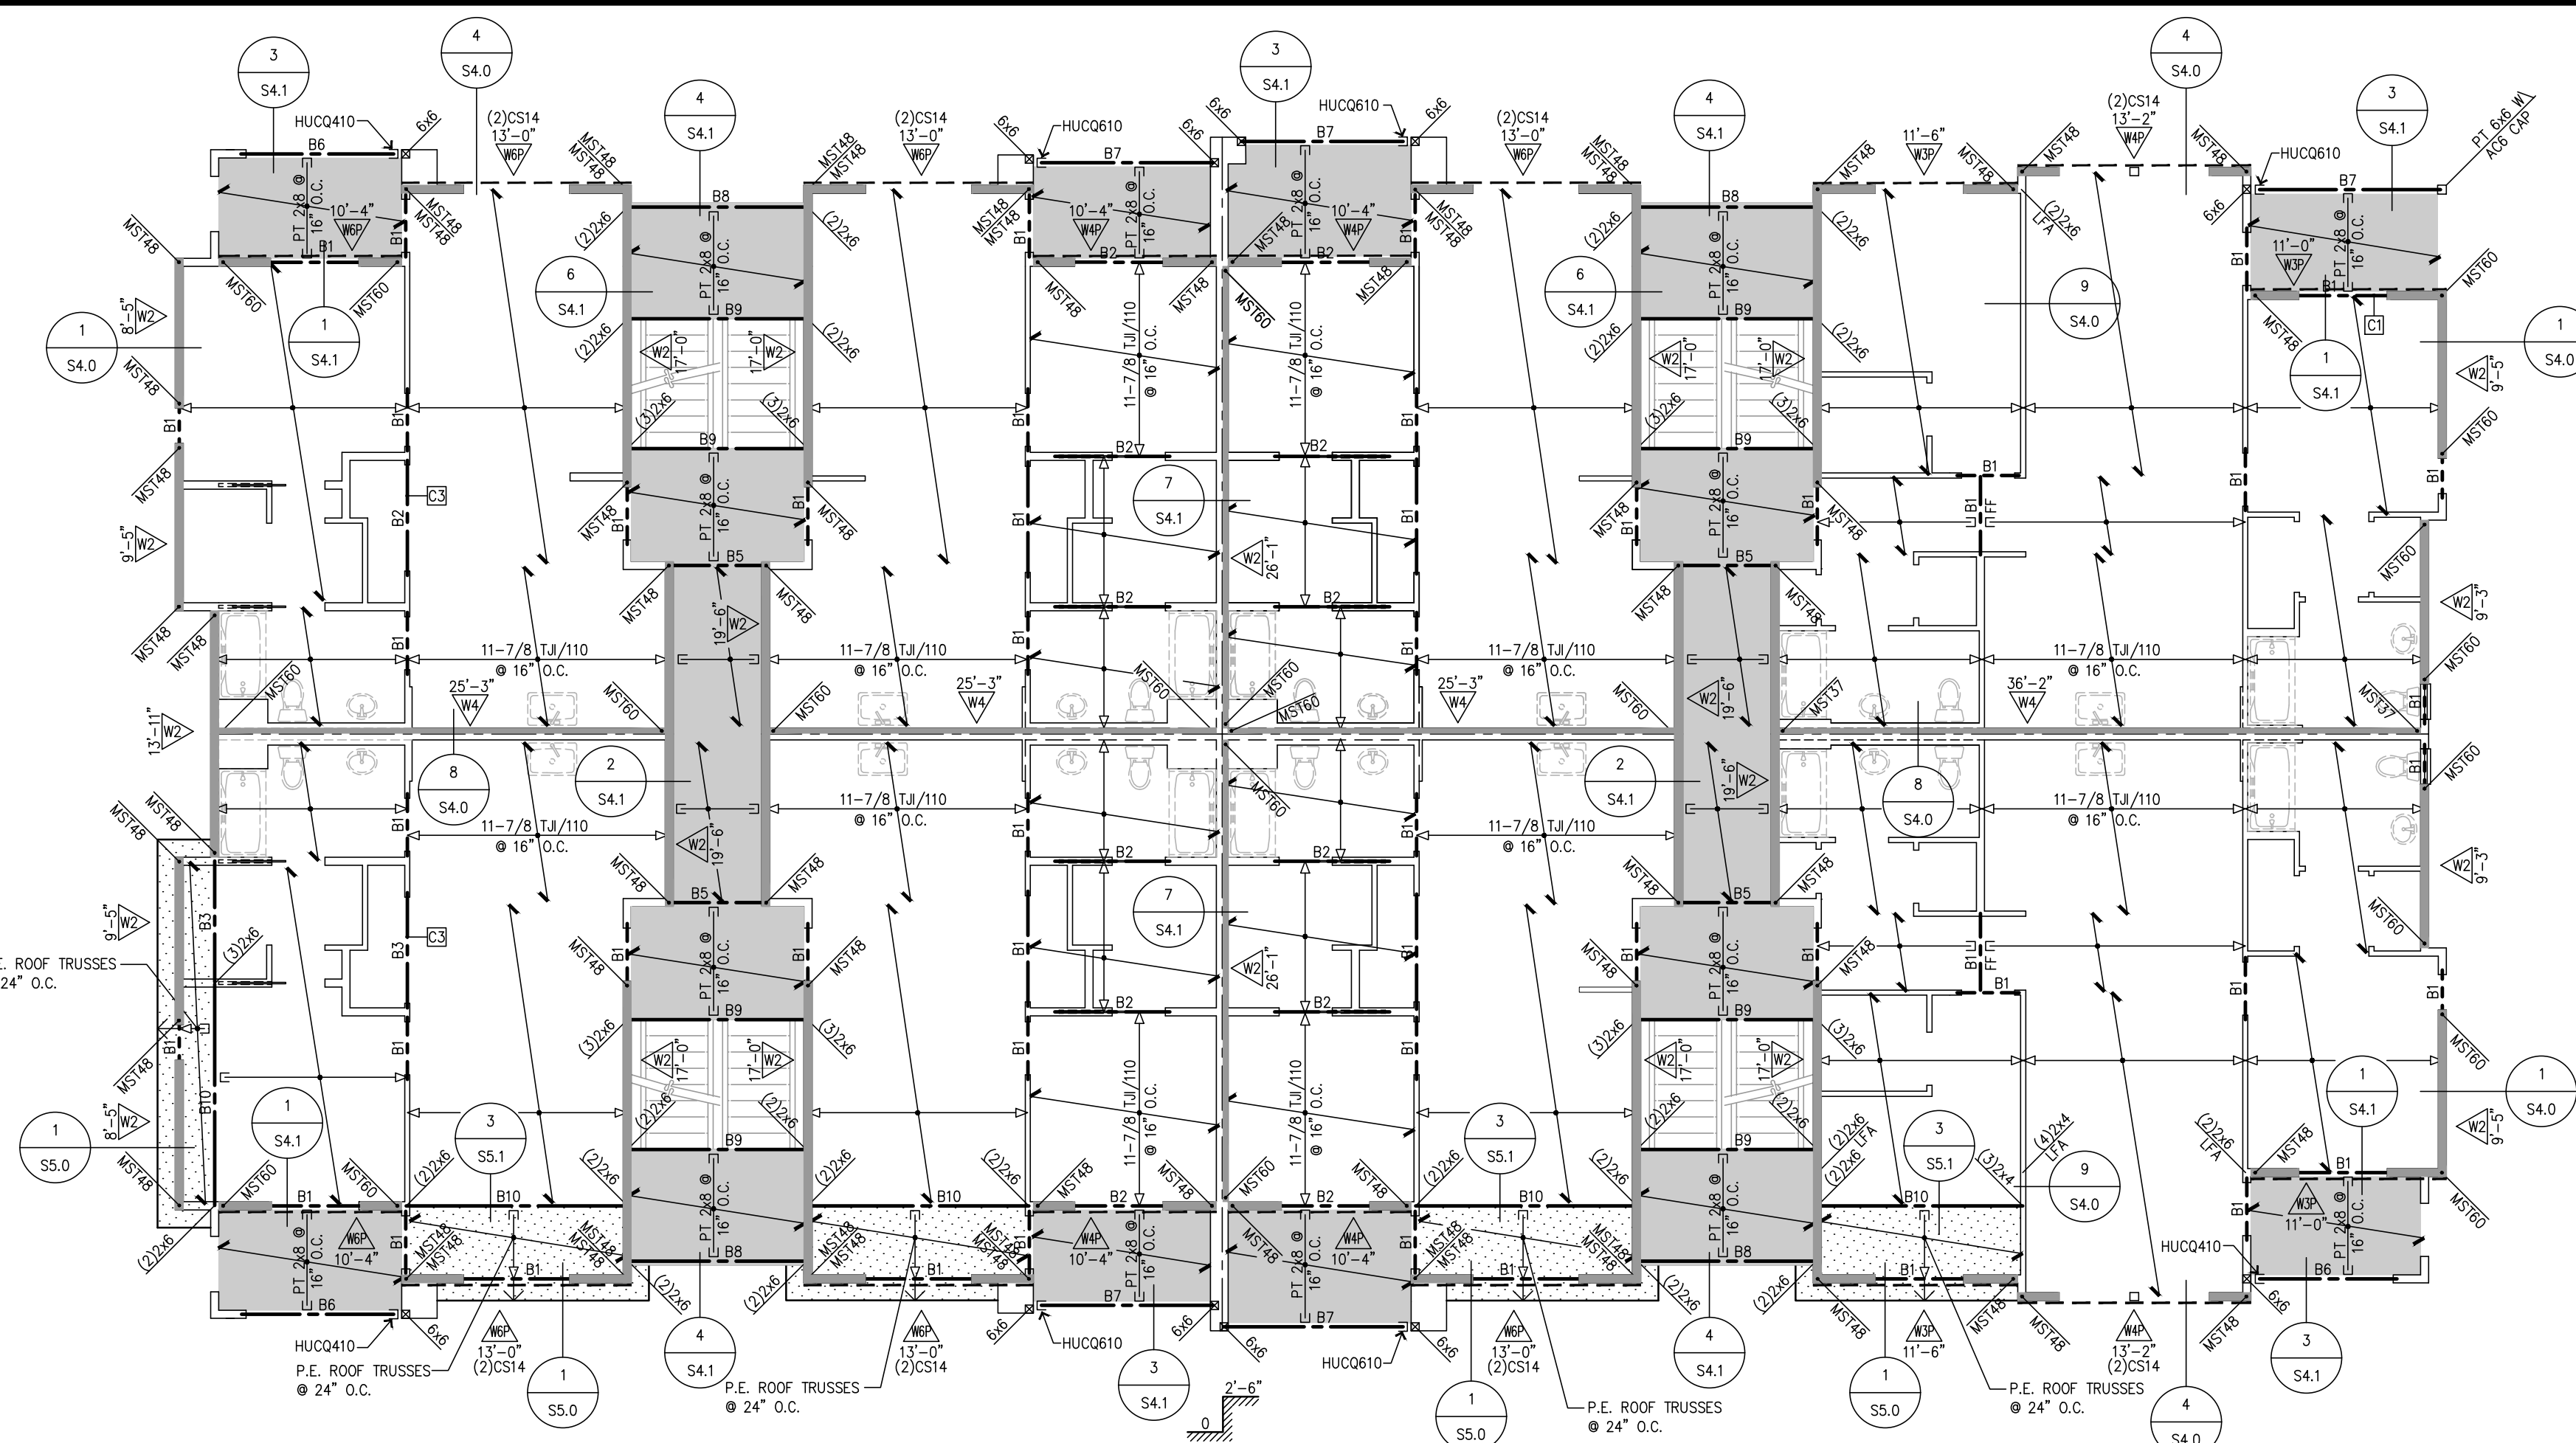



3rd Floor Framing Plan - Bldg A

SCALE 1/8"=1'-0"

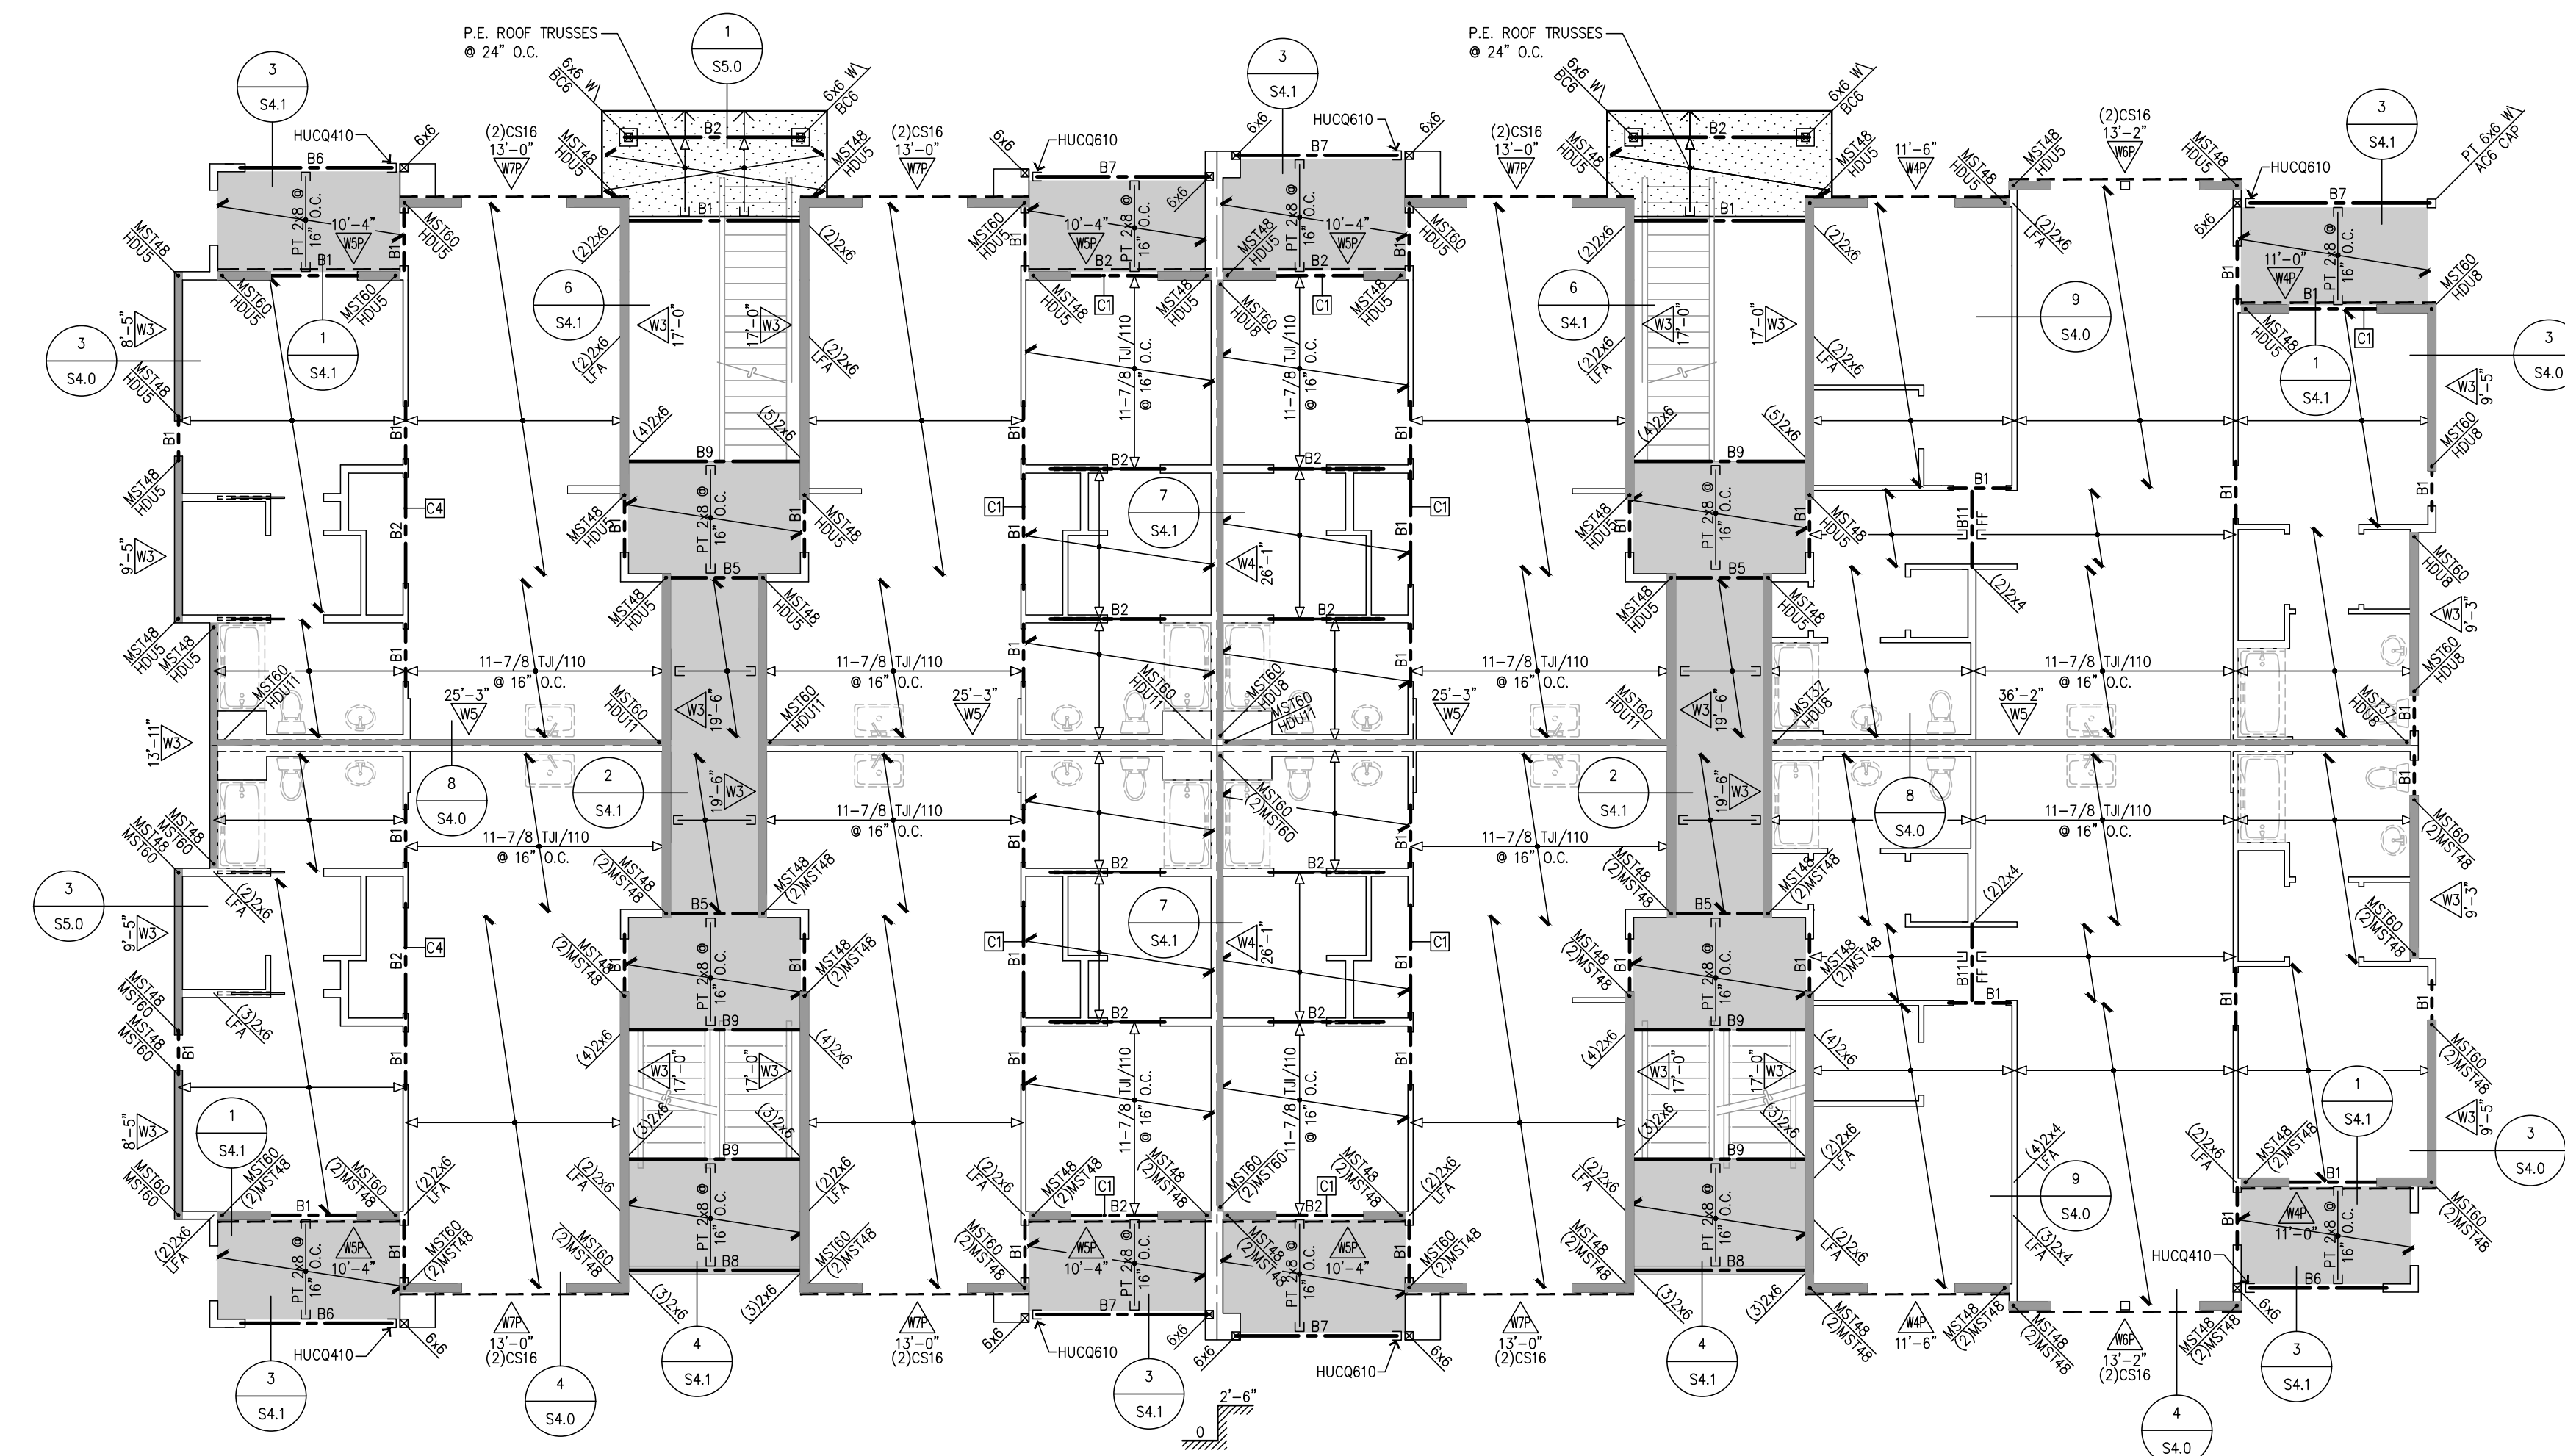

2nd Floor Framing Plan - Bldg A

SCALE 1/8"=1'-0"

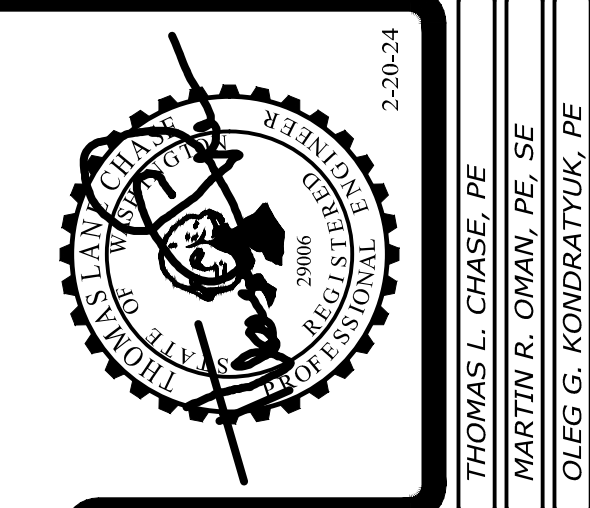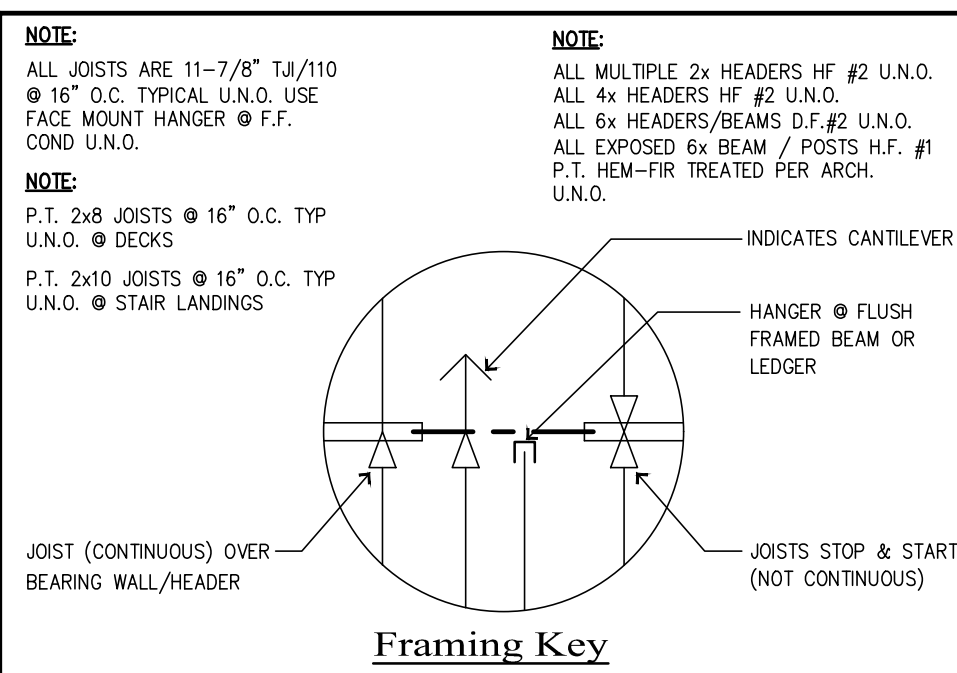

THOMAS L. CHASE, PE
 MARTIN R. OMAN, PE, SE
 OLEG G. KONDRATYUK, PE

Revisions to this sheet:

Bradley Heights Apartments
 202 27th Ave SE
 Puyallup, Washington

Solutions 4 Structures
 A Structural Engineering Corporation

Puyallup, Washington 98374
 Ph. 253-314-9822
 www.solutions4structures.com

PROJECT NO. : 23-007
 DESIGNED BY : TLC, OGG, MRO
 DRAWN BY : RSO
 ISSUE DATE : 2-20-24
 LATEST REV. OF DWG. SET :

SUBMITTAL SET ONLY NOT FOR CONSTRUCTION
 THESE DRAWINGS ARE SUBJECT TO REVISIONS PENDING LOCAL JURISDICTIONAL REVIEW.


S2.1

CAD FILE: F:\Projects\2023 Projects\Drawings\Drawings\S2.1.dwg PLOT DATE/TIME: 2/15/2024 - 9:27am THANK YOU FOR USING SOLUTIONS 4 STRUCTURES

Floor & Roof Framing Notes


- ROOF AND FLOOR JOIST LOCATIONS ARE SCHEMATICALLY SHOWN ON THE PLANS. IT IS NOT THE INTENT OF THE STRUCTURAL PLANS TO GRAPHICALLY LOCATE ALL FRAMING MEMBERS. THE ARCHITECT SHALL VERIFY THE COMPATIBILITY OF JOIST LAYOUT AND FRAMING W/ MECHANICAL, ELECTRICAL & PLUMBING AND ARCHITECTURAL PLANS. THE CONTRACTOR IS RESPONSIBLE FOR SPACING FRAMING MEMBERS AS NOTED ON THE PLANS AND GENERATING MEMBER LAYOUT FOR SHOP DRAWINGS AND QUANTITY TAKEOFFS.
- FOR ALL UNITS TYPES SEE WALL STUD SCHEDULE FOR BEARING WALL STUD REQUIREMENTS. ALL OTHER NON-BEARING 2x4 & 2x6 WALLS ARE AT 16" O.C.
- THE TRUSS AND JOIST MANUFACTURER SHALL VERIFY BEARING COMPATIBILITY (CRUSHING) WITH THE PLATE MATERIAL. TYPICALLY, COMPOSITE BEAMS SHALL BE FULLY BEARING ON 2x... WALLS. I.E. BREAK RIM OR BLOCKING TO ALLOW FULL BEARING OVER PLATES.
- PLACE LONG DIRECTION OF ALL OSB SHEETS PERPENDICULAR TO TRUSS/RAFTER OR JOIST DIRECTION, SEE DETAIL 3/S1.2. FLOOR SHEATHING IS TO BE CONTINUOUS FROM UNIT TO UNIT. TYPICAL NAILING AT FLOOR AND ROOF DIAPHRAGMS IS PROVIDED IN THE GENERAL STRUCTURAL NOTES ON SHEETS S1.0.
- INDICATES THE SHEARWALL TYPE, SEE THE SHEARWALL TABLE ON SHEET S1.2
 - INDICATES SHEARWALL LOCATION, THE CALLOUTS ON THE SHEARWALL TABLE APPLY ONLY ALONG THE LENGTH OF WALL SHOWN SHADED. PROVIDE SOLID BLOCKING IN FLOOR SPACE BELOW PERPENDICULAR SHEARWALLS.
 - INDICATES SHEAR WALL TYPE WITH OPENINGS. PROVIDE SHEATHING AROUND ALL OPENINGS AND ABOVE AND BELOW ALL OPENINGS. PROVIDE HORIZONTAL STRAPS & NAILING AT OPENINGS PER 8/S1.2
- THE DOUBLE TOP PLATE IS TO BE CONTINUOUS ALONG ALL EXTERIOR WALLS AND AT ALL WALL LINES CONTAINING SHEARWALLS. TYPICAL WALL TOP PLATE SPLICES SHALL BE PER DETAIL 7/S1.2 TYP.
- WHERE COMPOSITE JOISTS AND BEAMS ARE USED AS DRAG STRUTS THE MANUFACTURER SHALL PROVIDE THE FRAMING MEMBERS WITH THE CAPACITY CALLED OUT ON THE PLANS.
- TYPICAL FLOOR JOISTS SHALL BE 11-7/8" T&I/110 @ 16" O.C. TYP. U.N.O. THE MANUFACTURER SHALL BE RESPONSIBLE FOR ALL JOIST AND BEAM HANGERS, WEB STIFFENERS, SOLID BLOCKING, AND ADDITIONAL RIM OR JOIST MATERIAL TO ACCOMMODATE FLUSH-FRAMED CONDITIONS (F.F.), CANTILEVERED CONDITIONS, CONCENTRATED BEARING LOADS AND NAILING FROM SHEARWALLS ABOVE AND BELOW.
- F.F. = FLUSH-FRAMED BEAM. VERIFY FLUSH OR DROPPED BEAM CONDITION PER ARCHITECT.
- ALL BEAMS PER SCHEDULE U.N.O. ALL NON BEARING BEAMS SHALL BE A MIN OF (2)2x8 U.N.O. ALL OTHER BEAMS ARE AS MARKED ON PLANS.
- AT ALL BEAM BEARING/JAMB LOCATIONS, AT MINIMUM PROVIDE BEARING (TRIMMER) STRIPS AND FULL HEIGHT (KING) STUDS PER THE JAMB STUD SCHEDULE FOR EACH BUILDING IF PROVIDED. IF NO SCHEDULE, PROVIDE (1) 2x... BEARING AND (1) 2x... FULL HEIGHT STUD MINIMUM.
- EXPOSED FRAMING SHALL BE PRESSURE TREATED (P.T.) VERTICAL & HORIZONTAL FRAMING @ WATERPROOFED WALKWAYS AND PRIVATE DECKS. ALL EXPOSED BEAM HANGERS SHALL BE POST HOT-DIPPED GALVANIZED AND HAVE CONCEALED FLANGES, VERIFY W/ ARCHITECT. SEE NOTE ON SHEET S1.0
- FOR TYPICAL HOLDOWN ASSEMBLIES SEE THE HOLDOWN TABLE ON 2/S1.2 AND DETAILS ON SHEET S3.0.
- SEE ARCHITECTURAL PLANS FOR STAIR FRAMING DETAILS & STAIR FRAMING DETAILS AND NOTES. CONTROL JOINTS IN CONCRETE FLOORING AND ROOF VENTILATION REQUIREMENTS AND DETAILS.
- SEE CIVIL AND ARCHITECTURAL PLANS FOR TOP OF WALL HEIGHTS AND ELEVATIONS. SEE ARCHITECTURAL PLANS FOR DIMENSIONS. WHERE DIMENSIONS ARE SHOWN ON THE STRUCTURAL PLANS, CONTRACTOR SHALL VERIFY COMPATIBILITY W/ ARCHITECTURAL PLANS. WHERE DISCREPANCY EXISTS, CONTRACTOR SHALL NOTIFY BOTH THE ENGINEER AND ARCHITECT FOR CLARIFICATION.
- WINDOW SUPPLIER TO VERIFY THAT WINDOW AND WINDOW FRAMES TRANSFER WIND LOADS EVENLY TO STRUCTURAL FRAMING ON ALL 4 SIDES OF WINDOW. WINDOW SUPPLIER TO VERIFY MINIMUM .005H STORY DRIFT TOLERANCE IN PLANE OF ALL WINDOWS AND ALLOW FOR L/240 DEFLECTION (PERPENDICULAR) AT WINDOW MULLIONS.
- SEE GENERAL STRUCTURAL NOTES ON S1.0 TO S1.3 FOR ADDITIONAL INFORMATION.

18. LEGEND:
- INDICATES BEAM / GIRDER TRUSS PER PLAN SEE FRAMING PLANS
 - INDICATES HANGER PER MANUFACTURER
 - INDICATES GIRDER TRUSS PER PLAN
 - INDICATES JOIST / TRUSS BEARING @ WALL / BEAM
 - INDICATES JOIST / TRUSS INTERMEDIATE BEARING @ WALL / BEAM

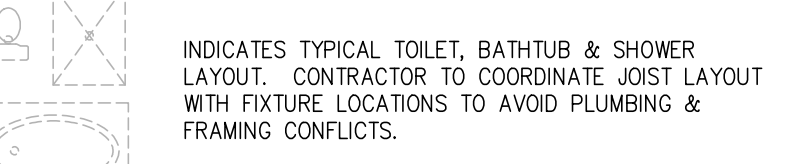

- INDICATES ROOF OVERFRAMING - SEE DETAILS 5/S5.0
- PROVIDE WALL FIREBLOCKING @ DROPPED SOFFITS SHOWN ON ARCH.
- PROVIDE WALL BLOCKING FOR ALL WALL MOUNTED EQUIPMENT (SUCH AS TOWEL BARS, GRAB BARS, TOILET PAPER HOLDERS, DOOR STOPS, ETC.).
- LFA INDICATES - LOAD FROM ABOVE
- FF INDICATES FLUSH FRAMED BEAM
- INDICATES STRAP HOLDOWN, SEE SHEET 2/S1.2 FOR HOLDOWN TABLE & UPPER TO LOWER WALL STRAP/HOLDOWN KEY.
- REFER TO ARCHITECTURAL DRAWINGS FOR ALL FLOOR ELEVATIONS.
- SIMPSON STRONG TIE PRODUCTS ARE CALLED OUT ON THE DRAWINGS, HOWEVER, EITHER SIMPSON OR KC METALS PRODUCTS MAY BE USED PROVIDED IT HAS SAME OR GREATER CAPACITY.

NOTE:
 ALL JOISTS ARE 11-7/8" T&I/110 @ 16" O.C. TYPICAL U.N.O. USE FACE MOUNT HANGER @ F.F. COND U.N.O.
 P.T. 2x8 JOISTS @ 16" O.C. TYP U.N.O. @ DECKS
 P.T. 2x10 JOISTS @ 16" O.C. TYP U.N.O. @ STAIR LANDINGS

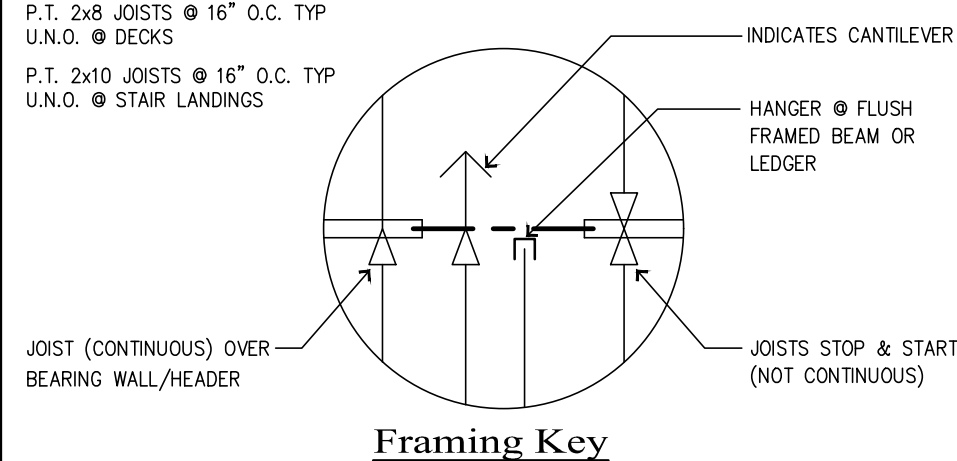

SEE SHEET S1.2 FOR SHEARWALL AND HOLDOWN TABLES




MARK	BEAM SIZE
B1	4x8
B2	4x10
B3	6x10 DF #2
B4	3-1/8 x 10-1/2 GLB
B5	P.T. 4x8
B6	P.T. 4x10
B7	P.T. 6x10 HF#1
B8	P.T. 3-1/8 x 10-1/2 GLB
B9	P.T. 5-1/8 x 10-1/2 GLB
B10	5-1/4x11-7/8 PSL
B11	3-1/2x11-7/8 LSL

TYPE	C1	C2	C3	C4	C5	C6	-	-
BEARING/FULL HT STUDS	1/2	1/3	2/1	2/2	2/3	2/4	-	-

NOTE: STUD SIZE SHOULD MATCH WALL SIZE PER PLAN.

FRAMING LEVEL	2x6 EXTERIOR	2x6 BRG INT SINGLE WALL	2x6 BRG INT PARTY WALLS	2x4 BRG SINGLE WALL	2x4 BRG PARTY WALLS
ROOF	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x4 HF#2 @ 16" O.C.	2x4 HF#2 @ 16" O.C.
3RD	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x4 HF#2 @ 16" O.C.	2x4 HF#2 @ 16" O.C.
2ND	2x6 @ 16" O.C.	2x6 @ 16" O.C.	2x6 @ 16" O.C.	(2)2x4 HF#2 @ 16" O.C.	2x4 HF#2 @ 16" O.C.
BASEMENT	2x6 @ 16" O.C.	2x6 @ 12" O.C.	2x6 @ 16" O.C.	(2)2x4 HF#2 @ 12" O.C.	2x4 HF#2 @ 16" O.C.

NOTES:
 1. ALL STUD MATERIAL SHALL BE HEM FIR STUD GRADE OR BETTER UNLESS NOTED OTHERWISE AND PLATE MATERIAL SHALL BE HEM FIR STANDARD OR BETTER UNLESS NOTED OTHERWISE.
 2. STUDS CALLED OUT IN THIS SCHEDULE ARE FOR WALL SUPPORTING THE FRAMING LEVEL INDICATED, THAT IS WALLS BELOW THE FRAMING LEVEL SHOWN.
 3. THIS SCHEDULE COVERS BUILDING UNITS 3 STORES IN HEIGHT. FIRST, DETERMINE THE NUMBER OF STORES FOR THE UNIT, SECOND, DETERMINE THE FRAMING LEVEL, THIRD, READ SCHEDULE HORIZONTALLY FOR THE WALL LOCATION.

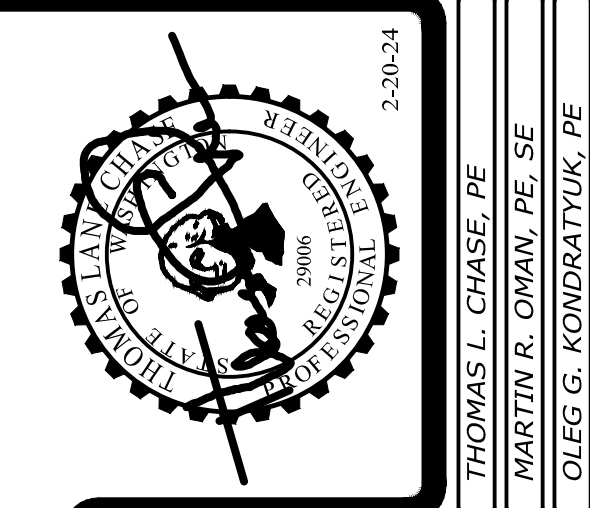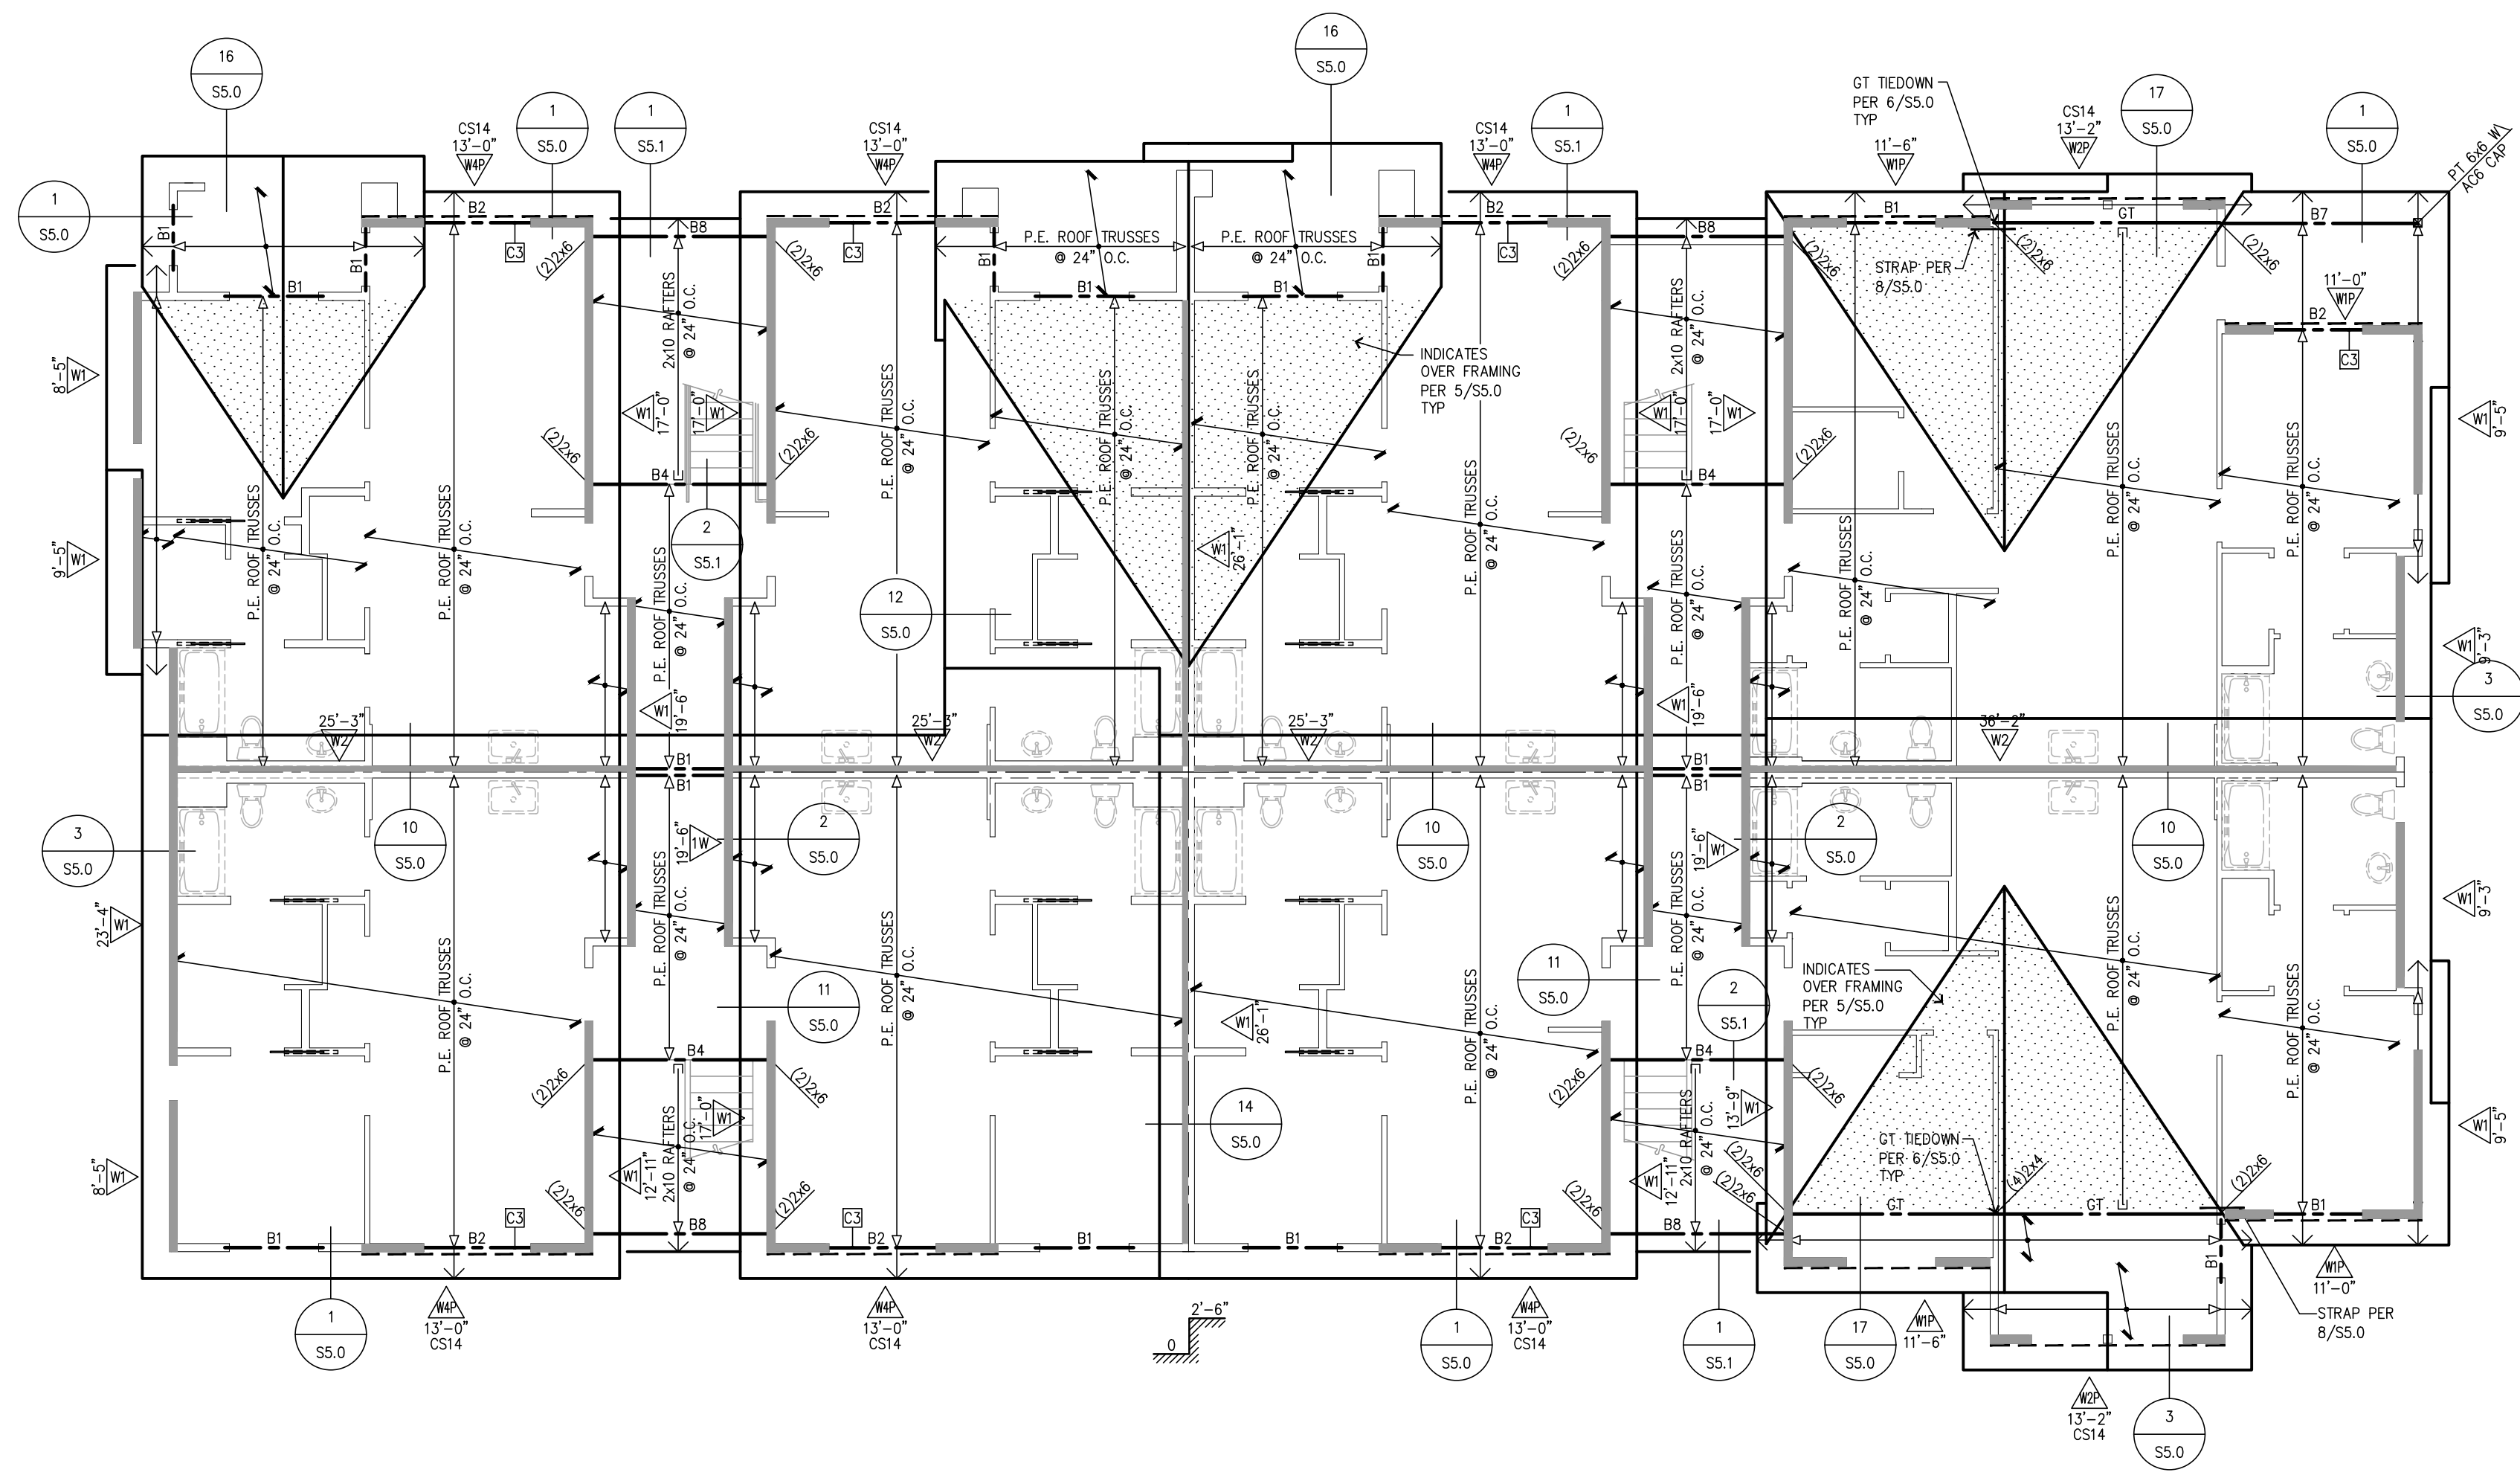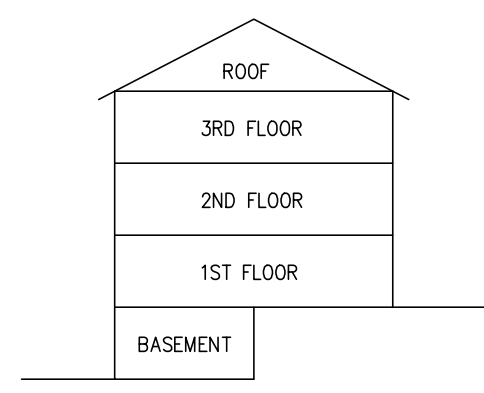

Revisions to this sheet:

Bradley Heights Apartments
 202 27th Ave SE
 Puyallup, Washington

Solutions 4 Structures
 A Structural Engineering Corporation

PROJECT NO. : 23.007
 DESIGNED BY : TLC, OGG, MRO
 DRAWN BY : RSO
 ISSUE DATE : 2-20-24
 LATEST REV. OF DWG. SET :





















Puyallup, Washington 98374
 Ph. 253-314-9822
 www.solutions4structures.com

SUBMITTAL SET ONLY NOT FOR CONSTRUCTION
 THESE DRAWINGS ARE SUBJECT TO REVISIONS PENDING LOCAL JURISDICTIONAL REVIEW.

S2.2

CAD FILE: F:\Projects\2023\Projects\23.007\Bradley Heights\Drawings\S2.2.dwg PLOT DATE/TIME: 2/15/2024 - 9:29am THANK YOU FOR USING SOLUTIONS 4 STRUCTURES

CAD FILE: F:\Projects\2023 Projects\33.007 Bradley Heights\Drawings\S3.0.dwg
 PLOT DATE/TIME: 2/15/2024 - 9:46am THANK YOU FOR USING SOLUTIONS 4 STRUCTURES

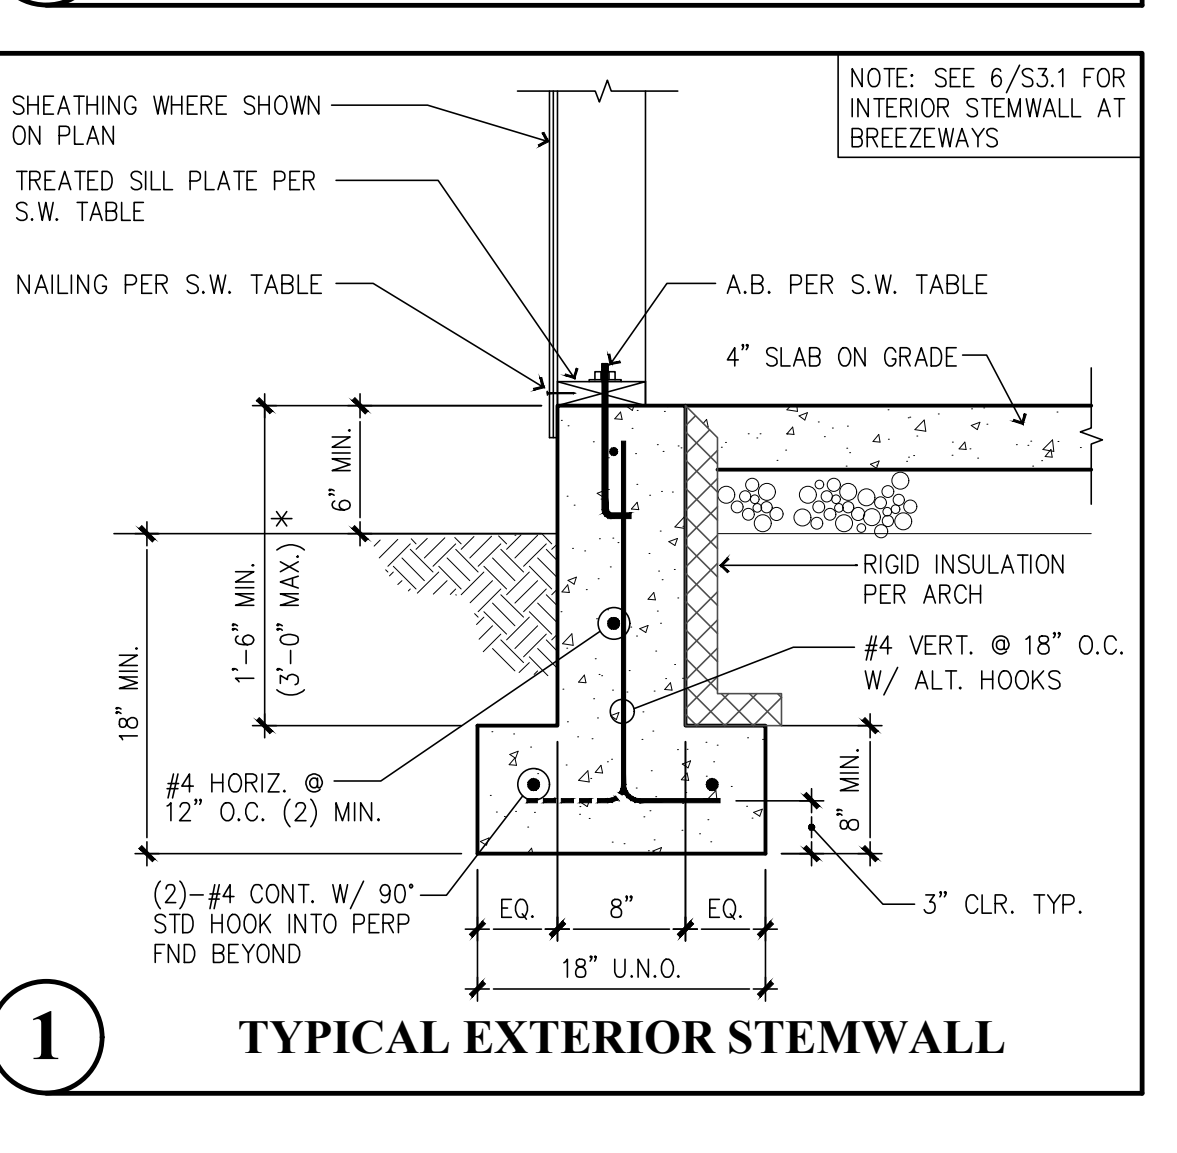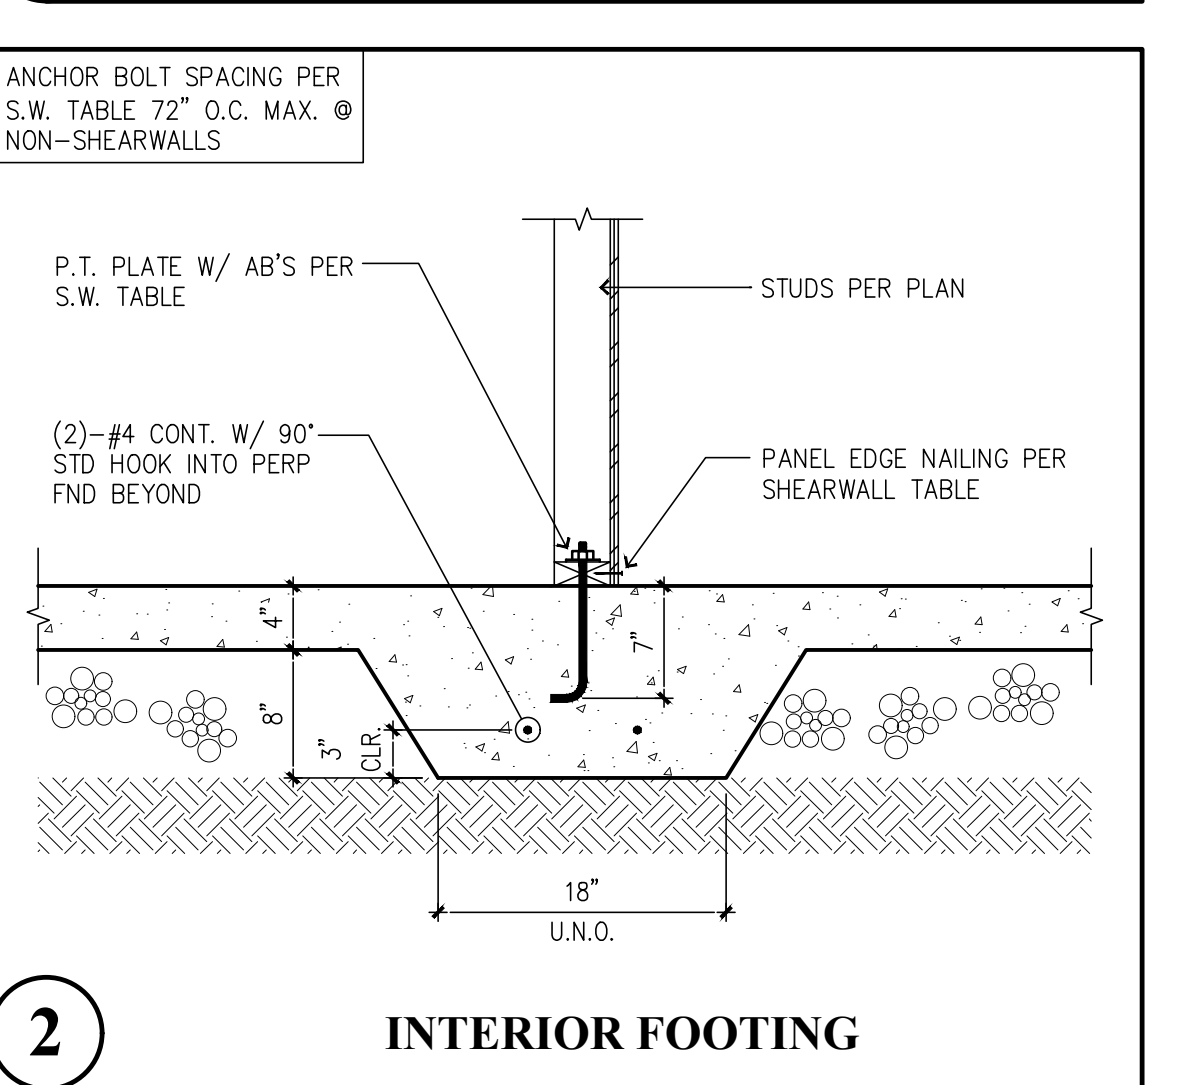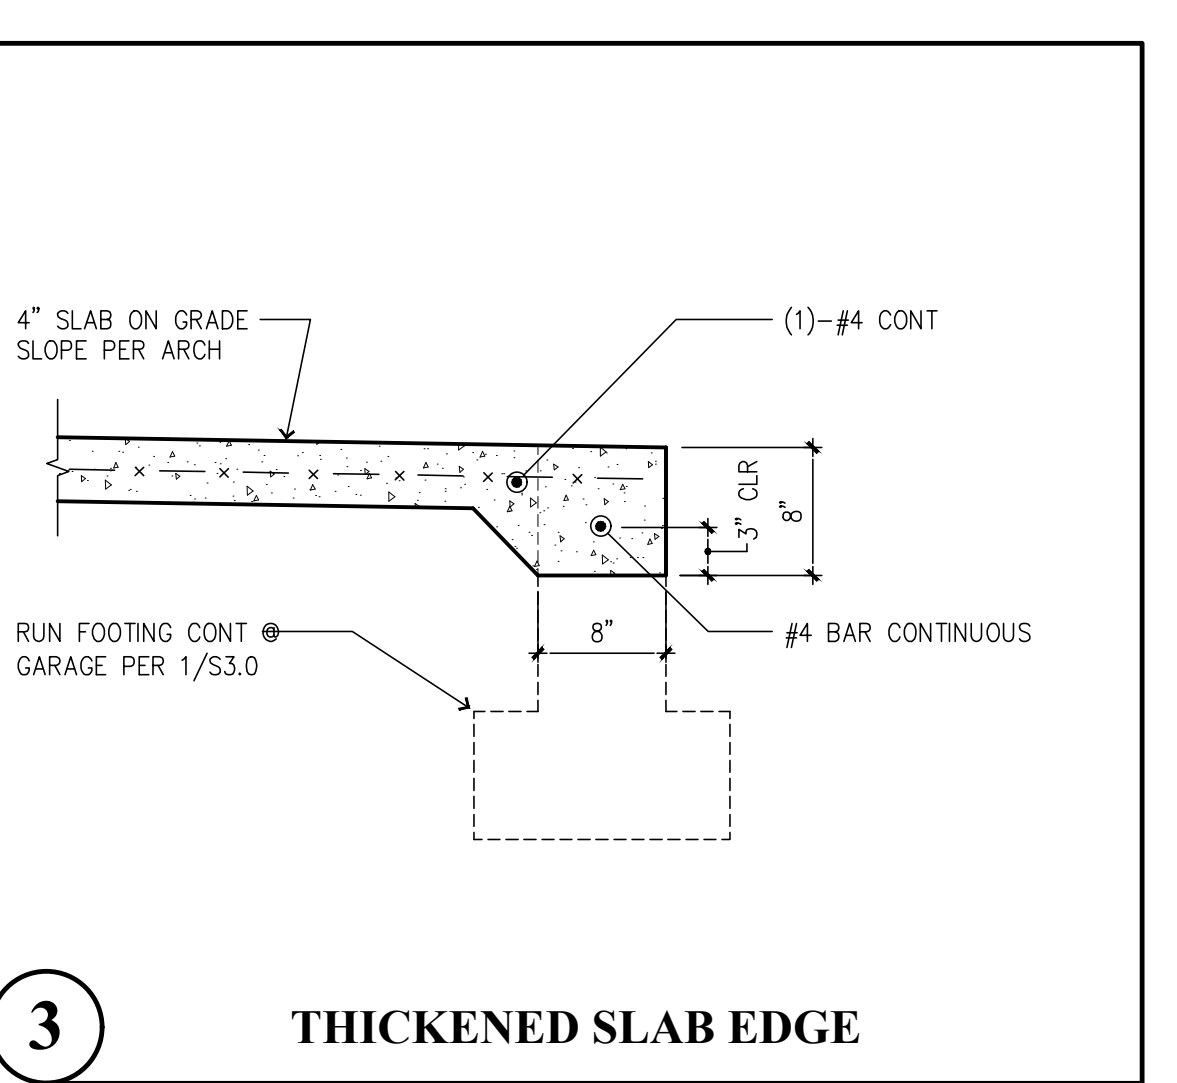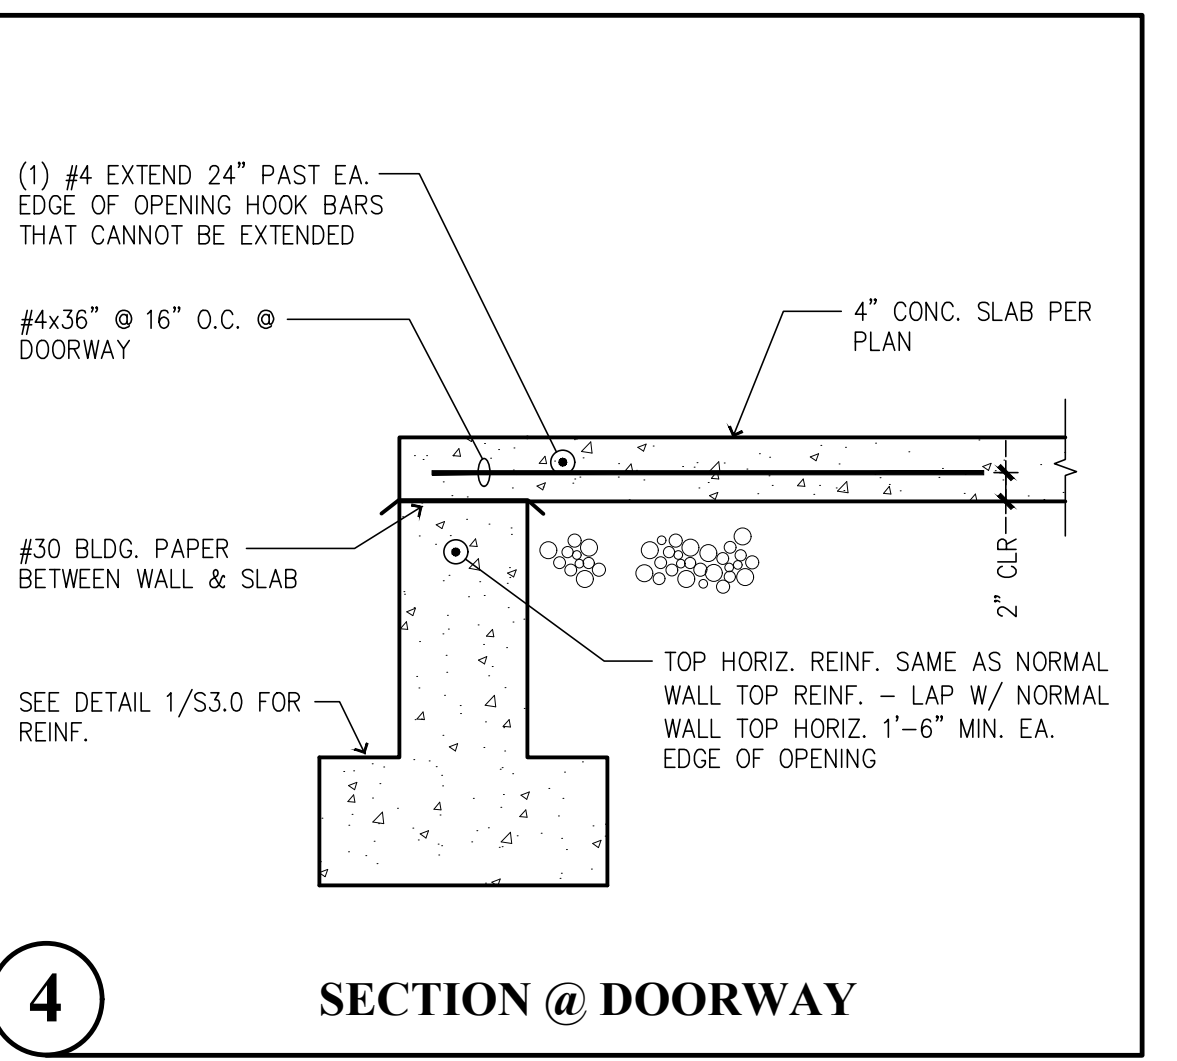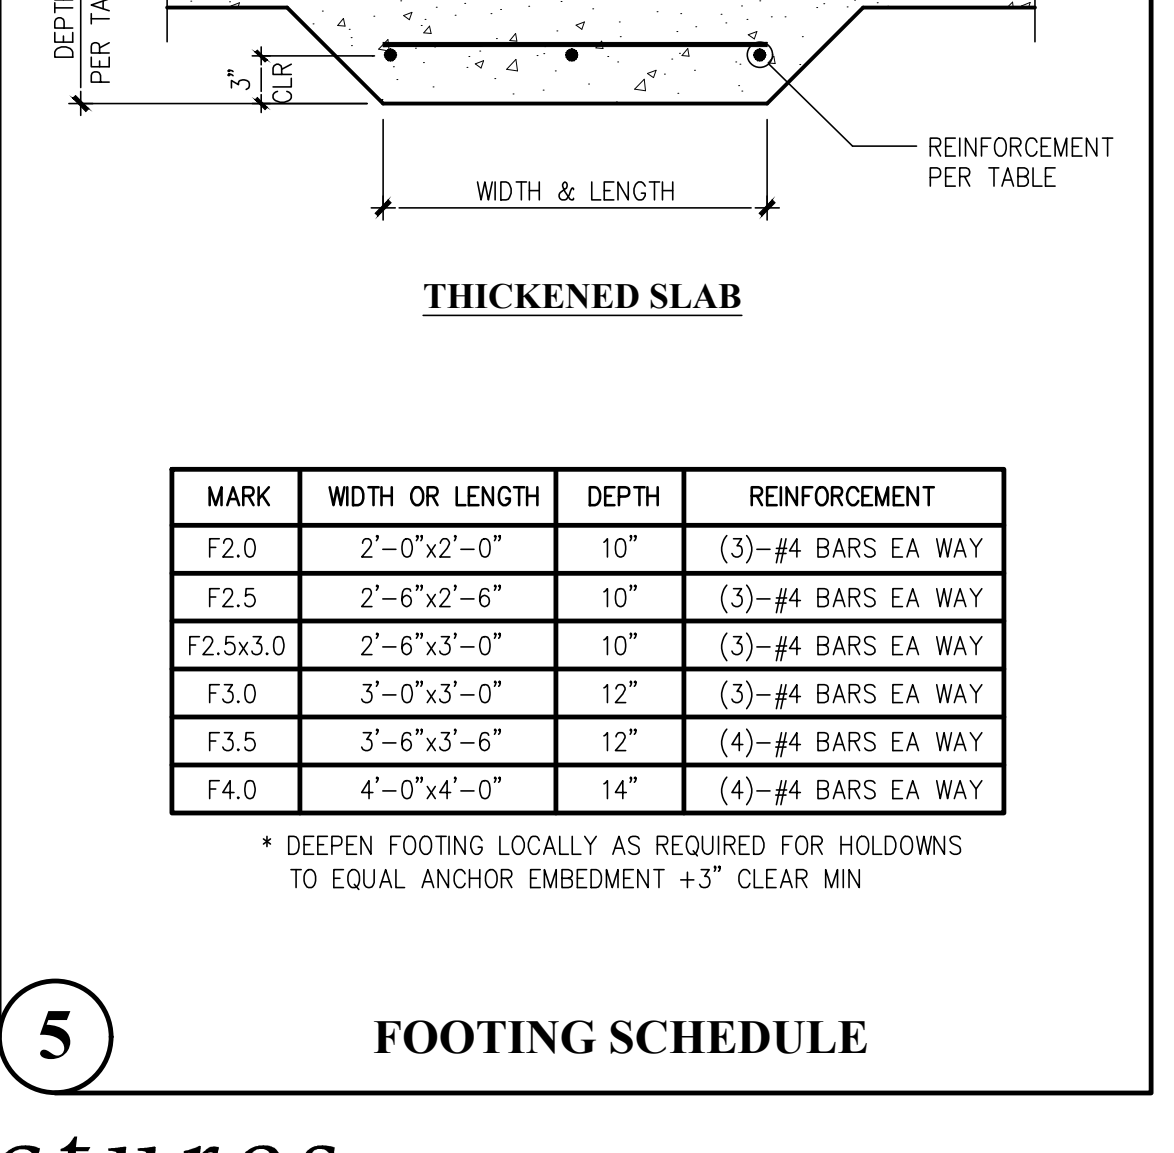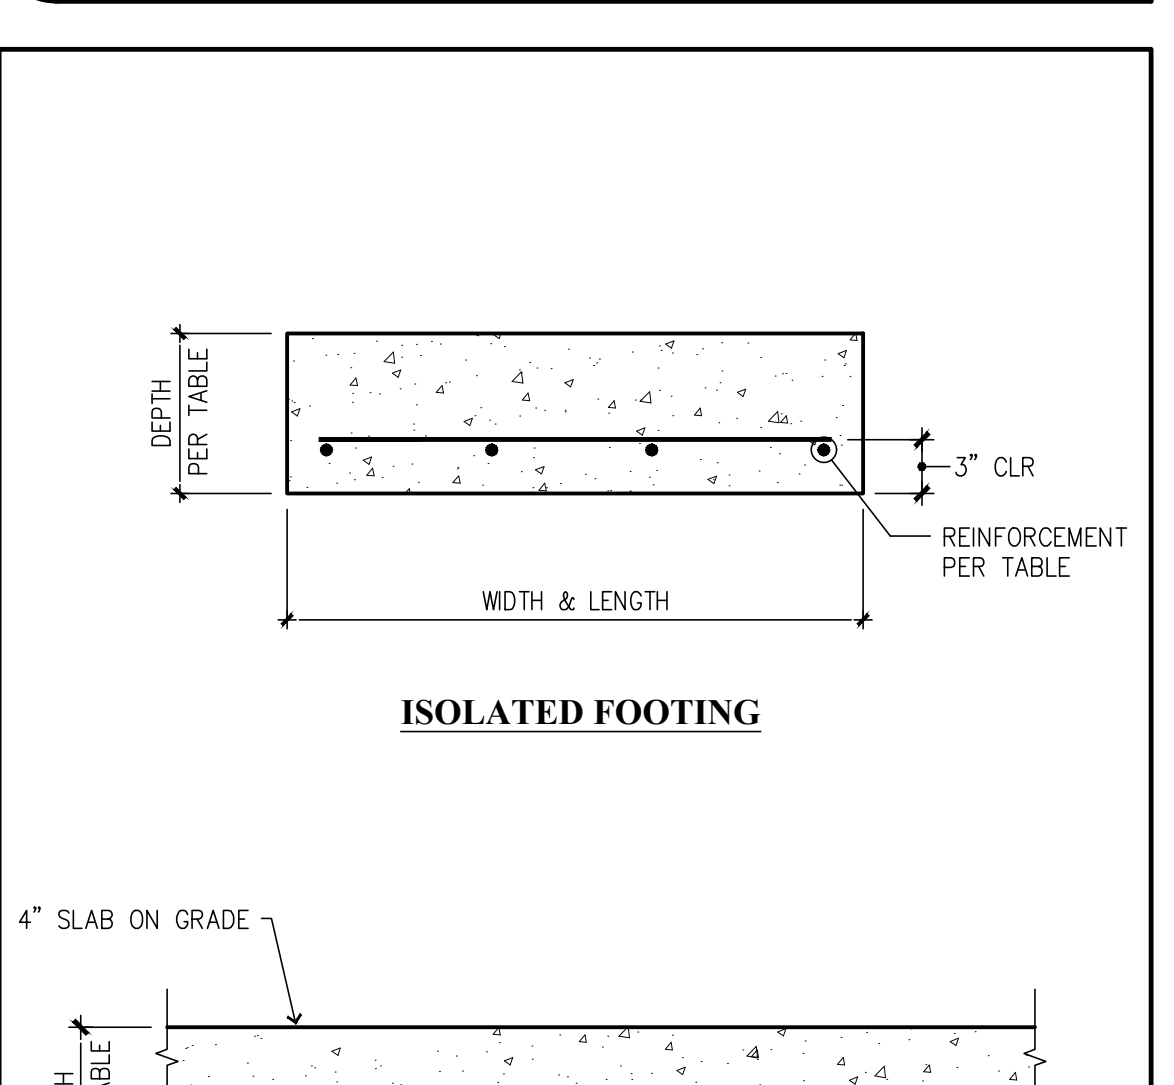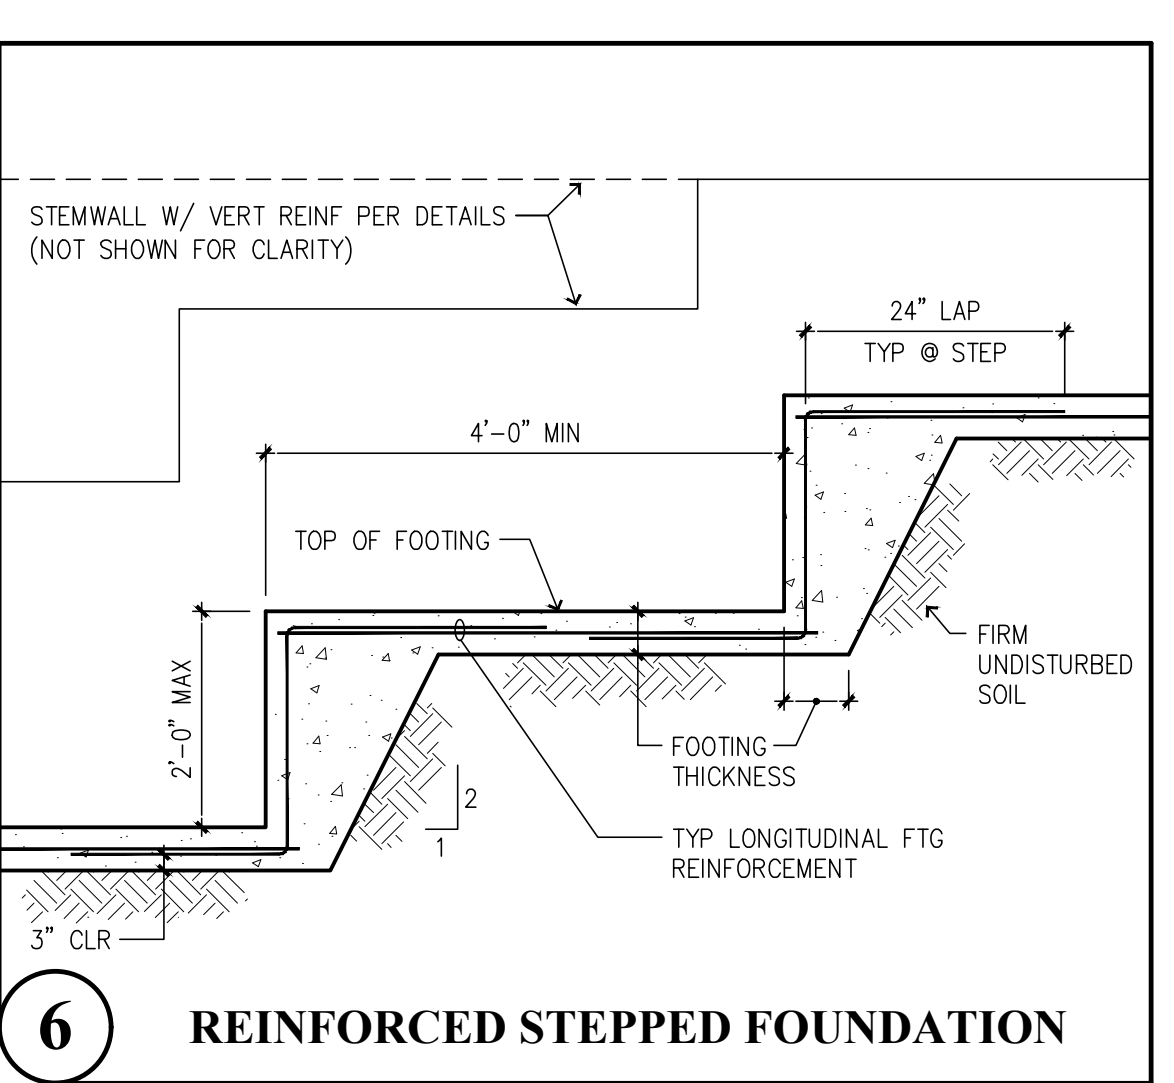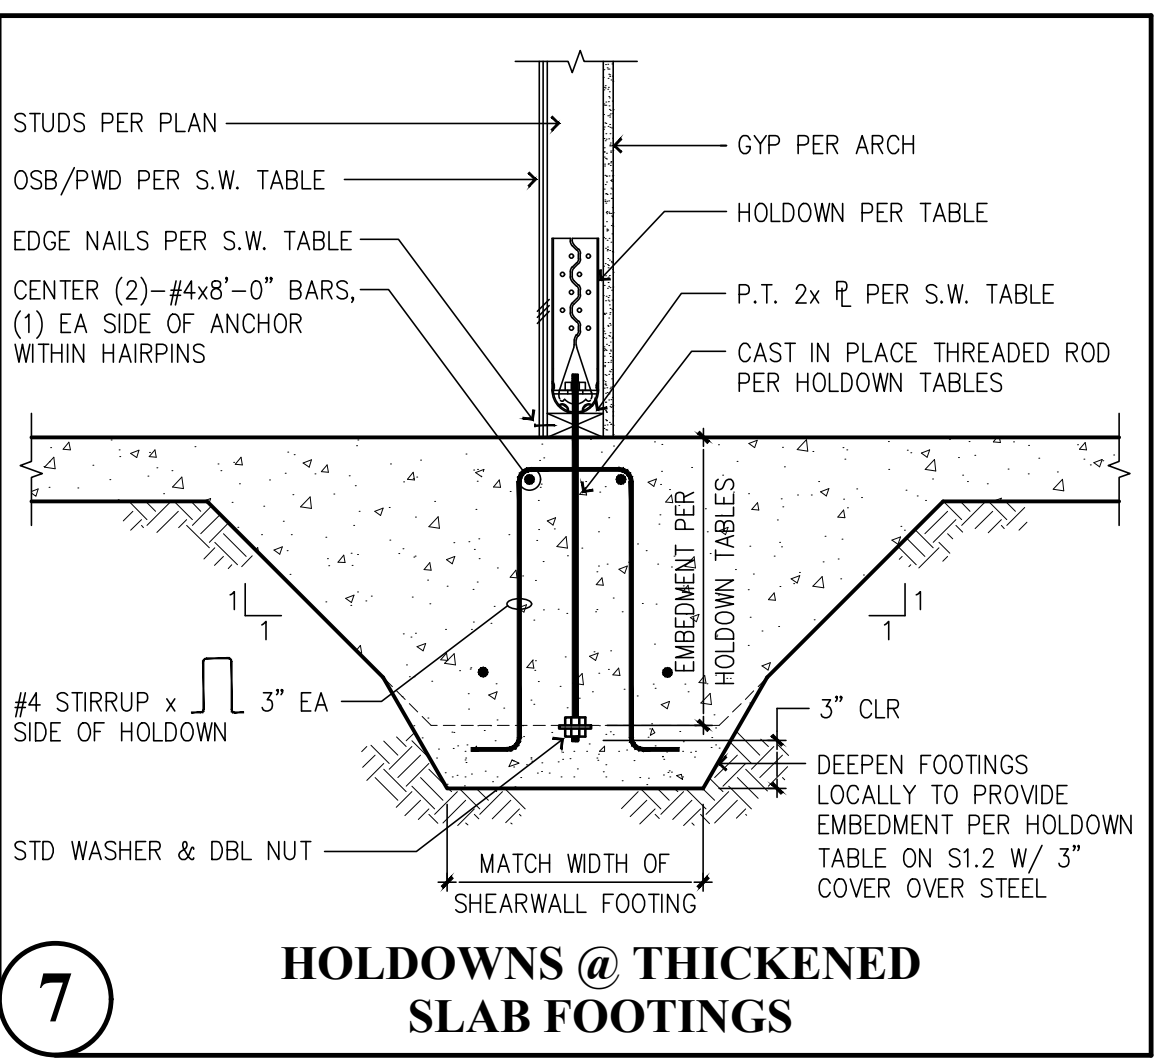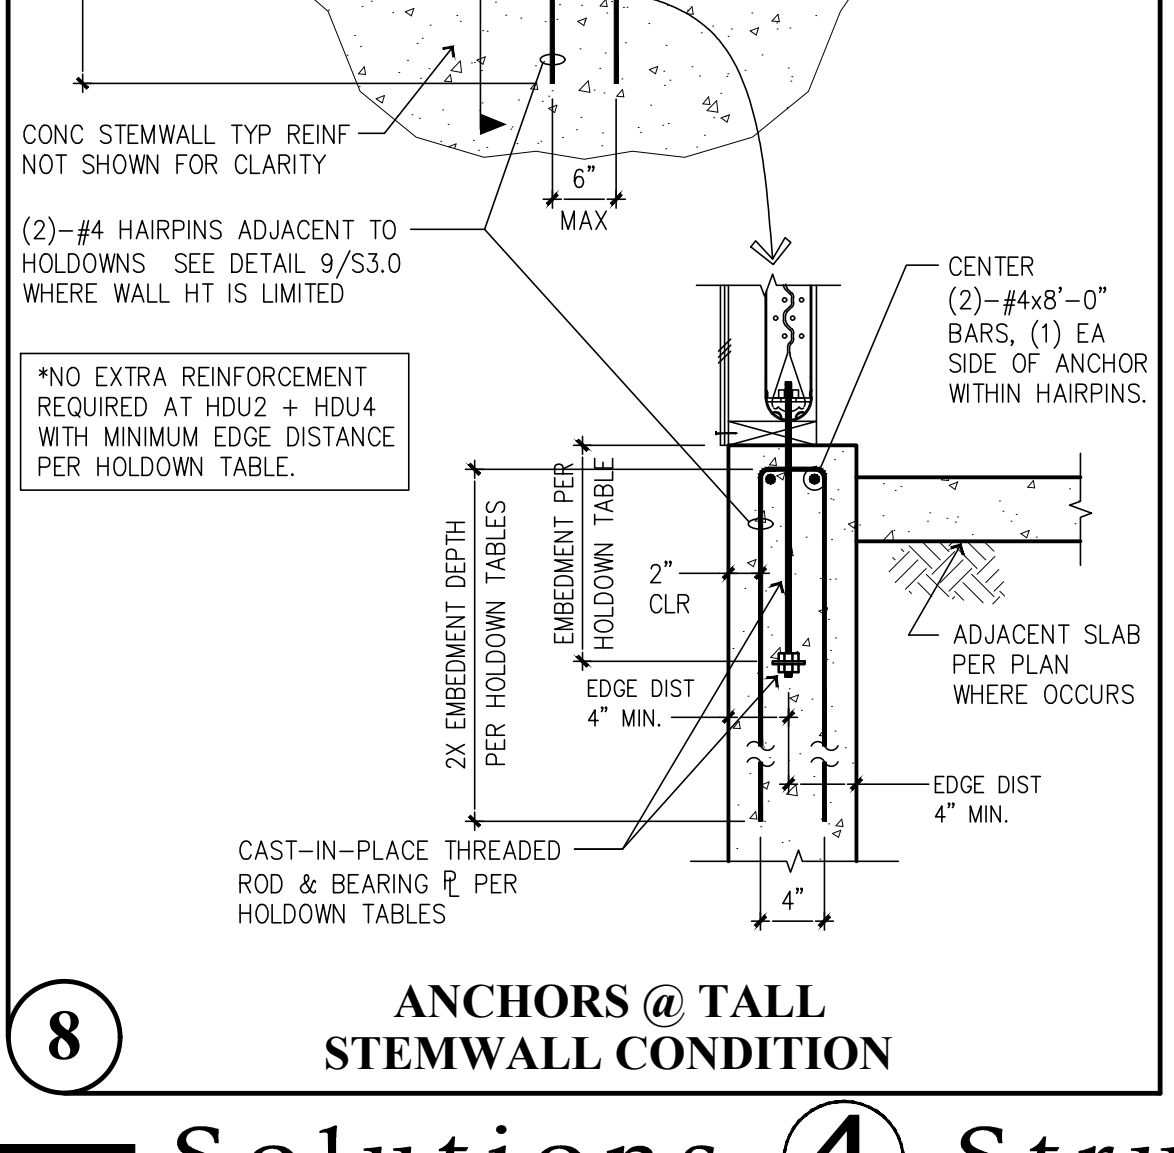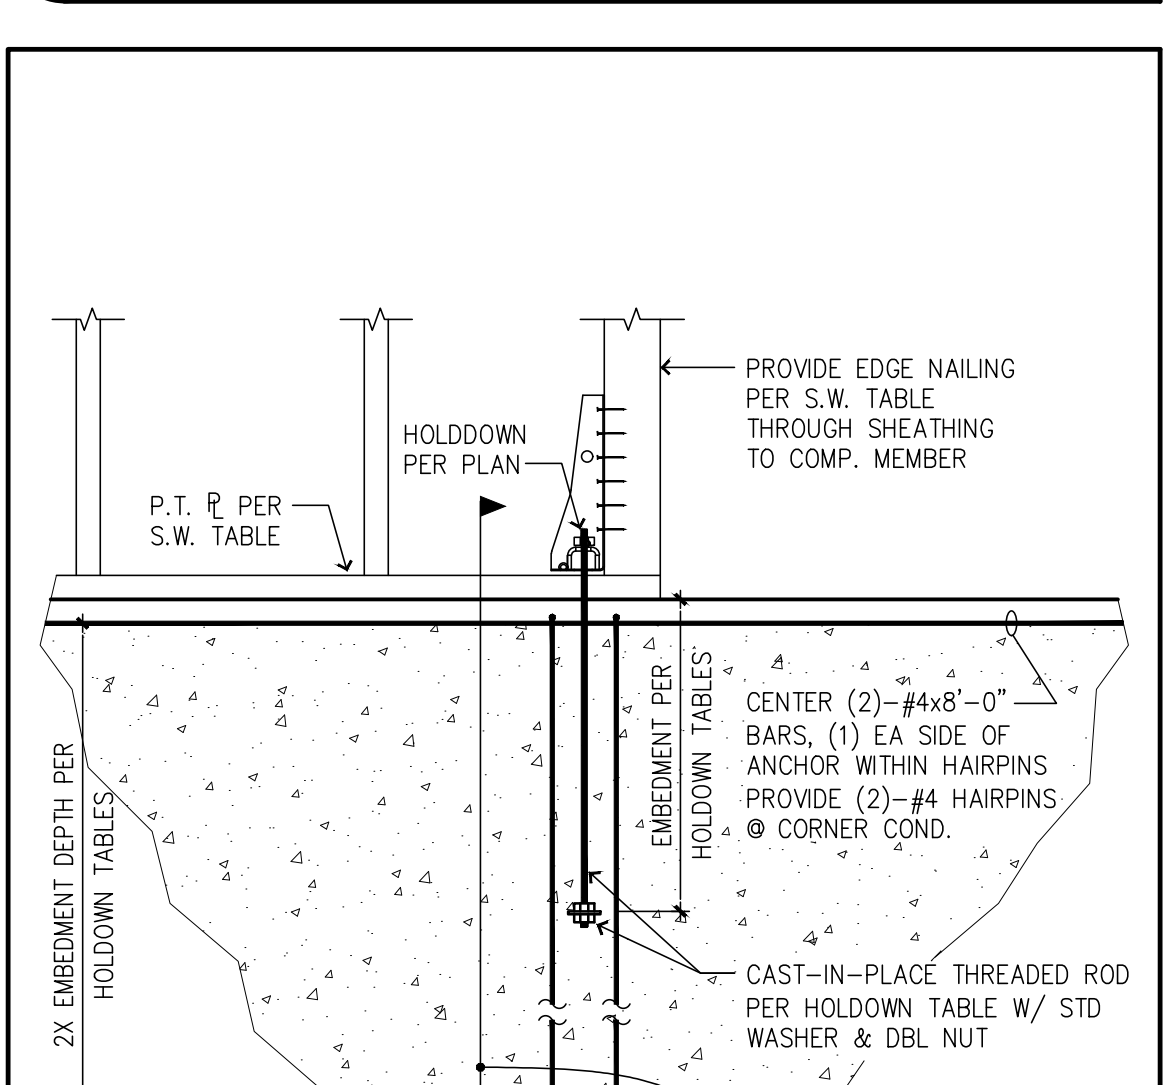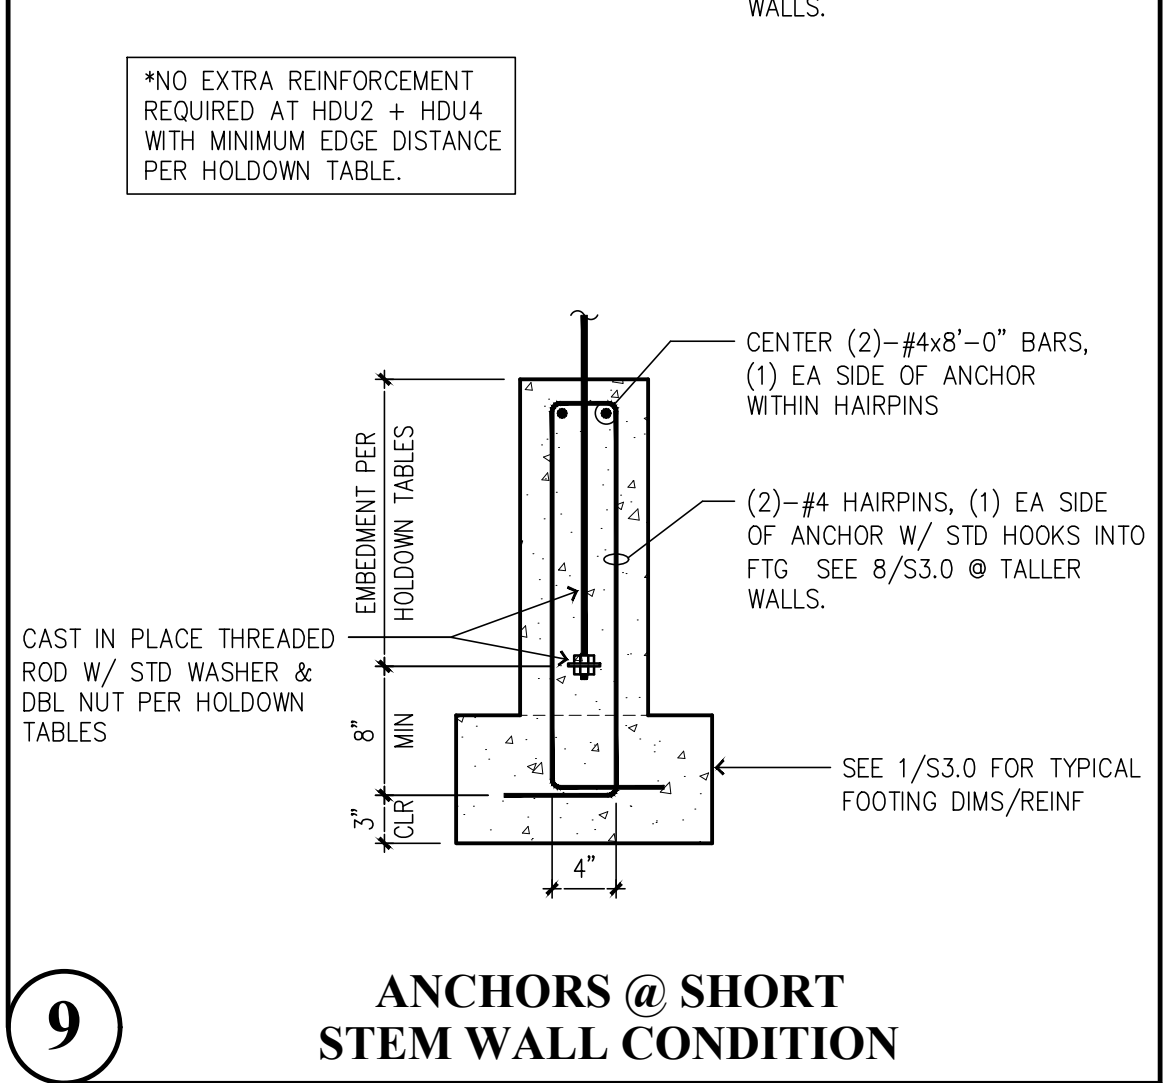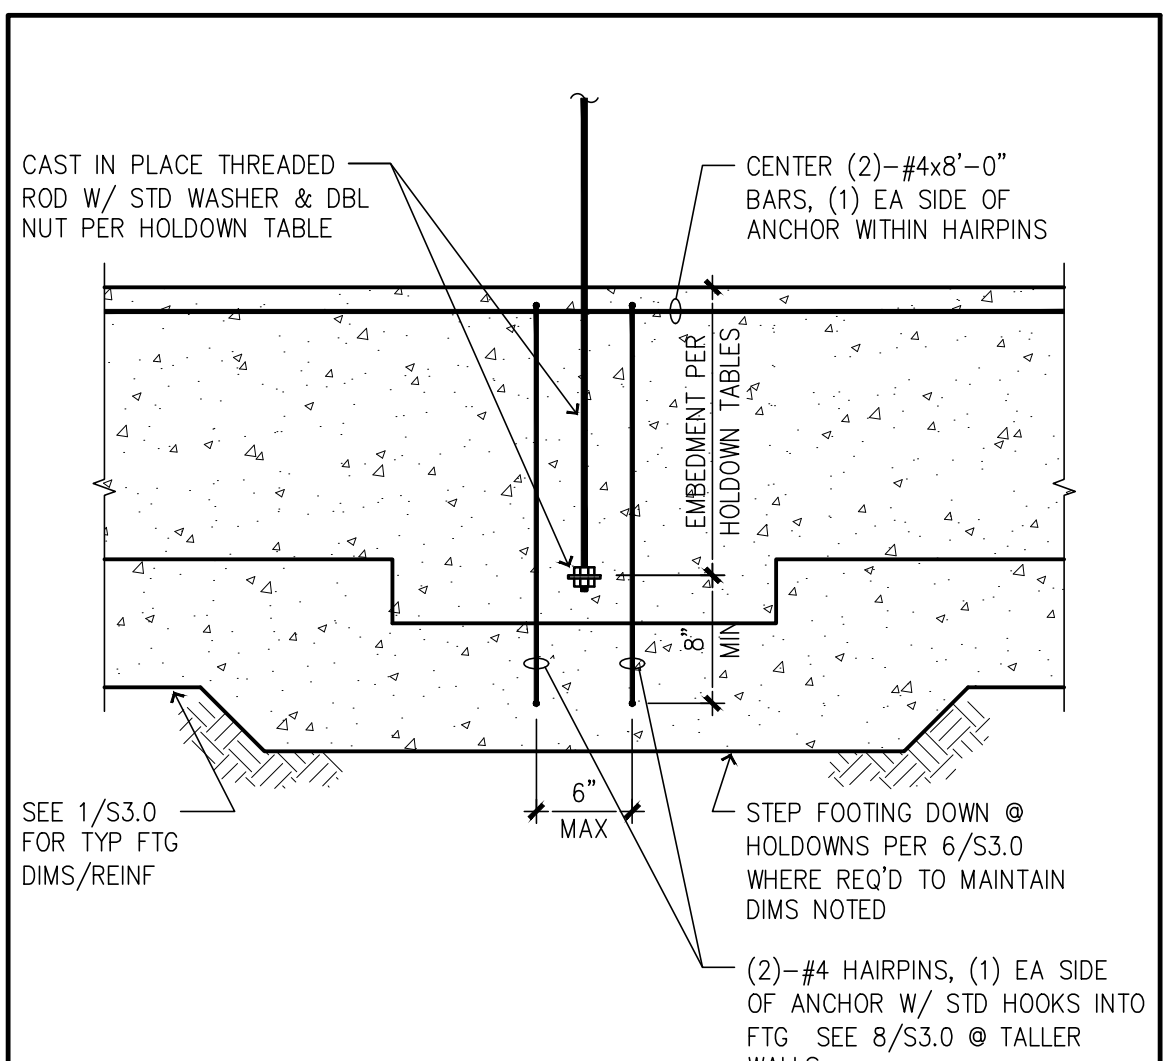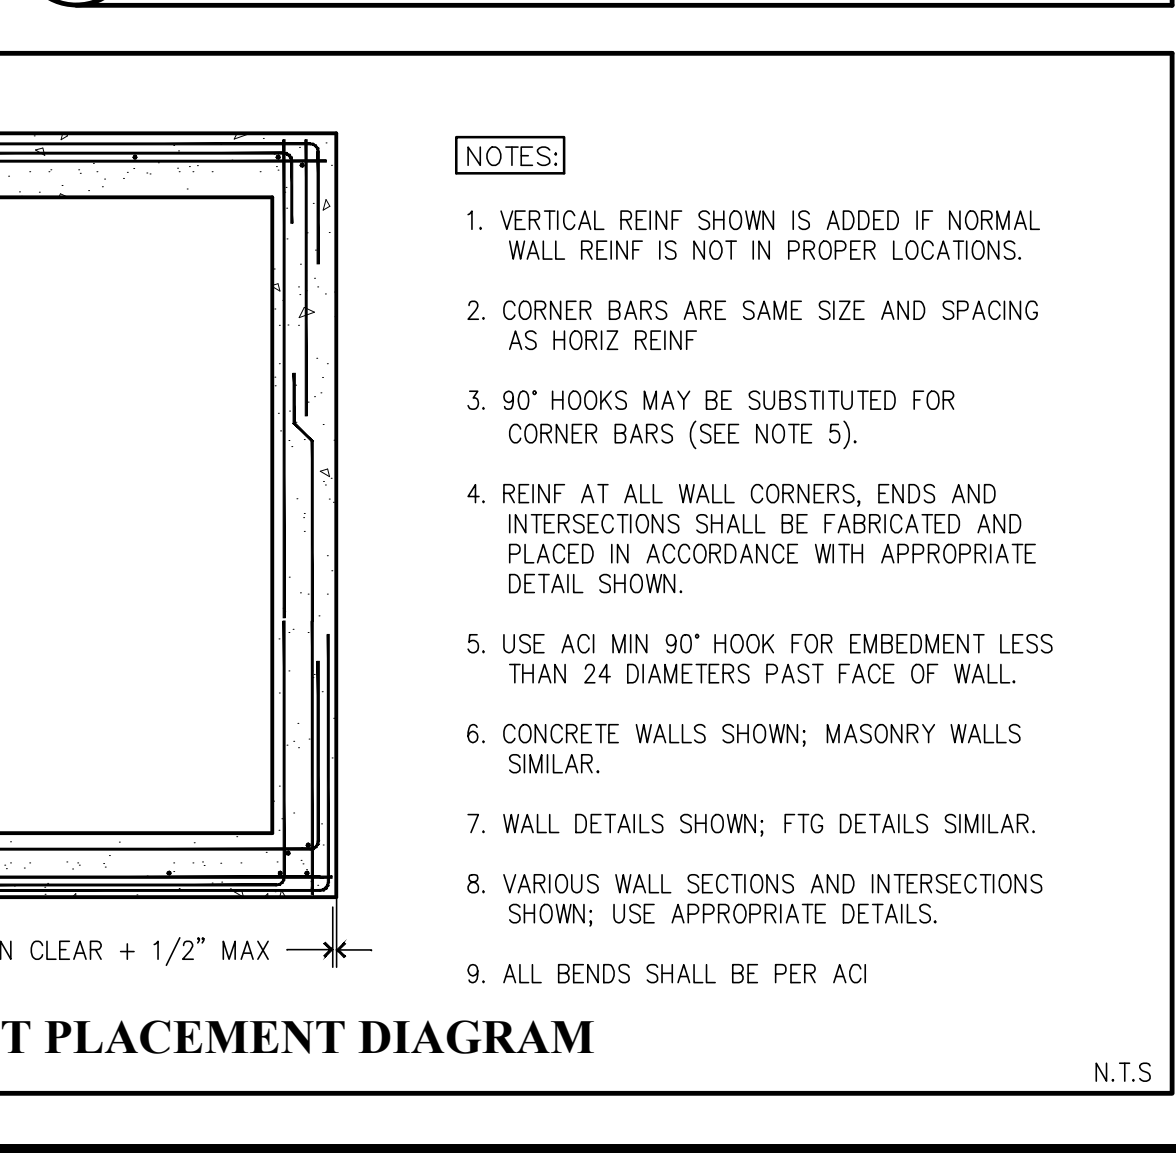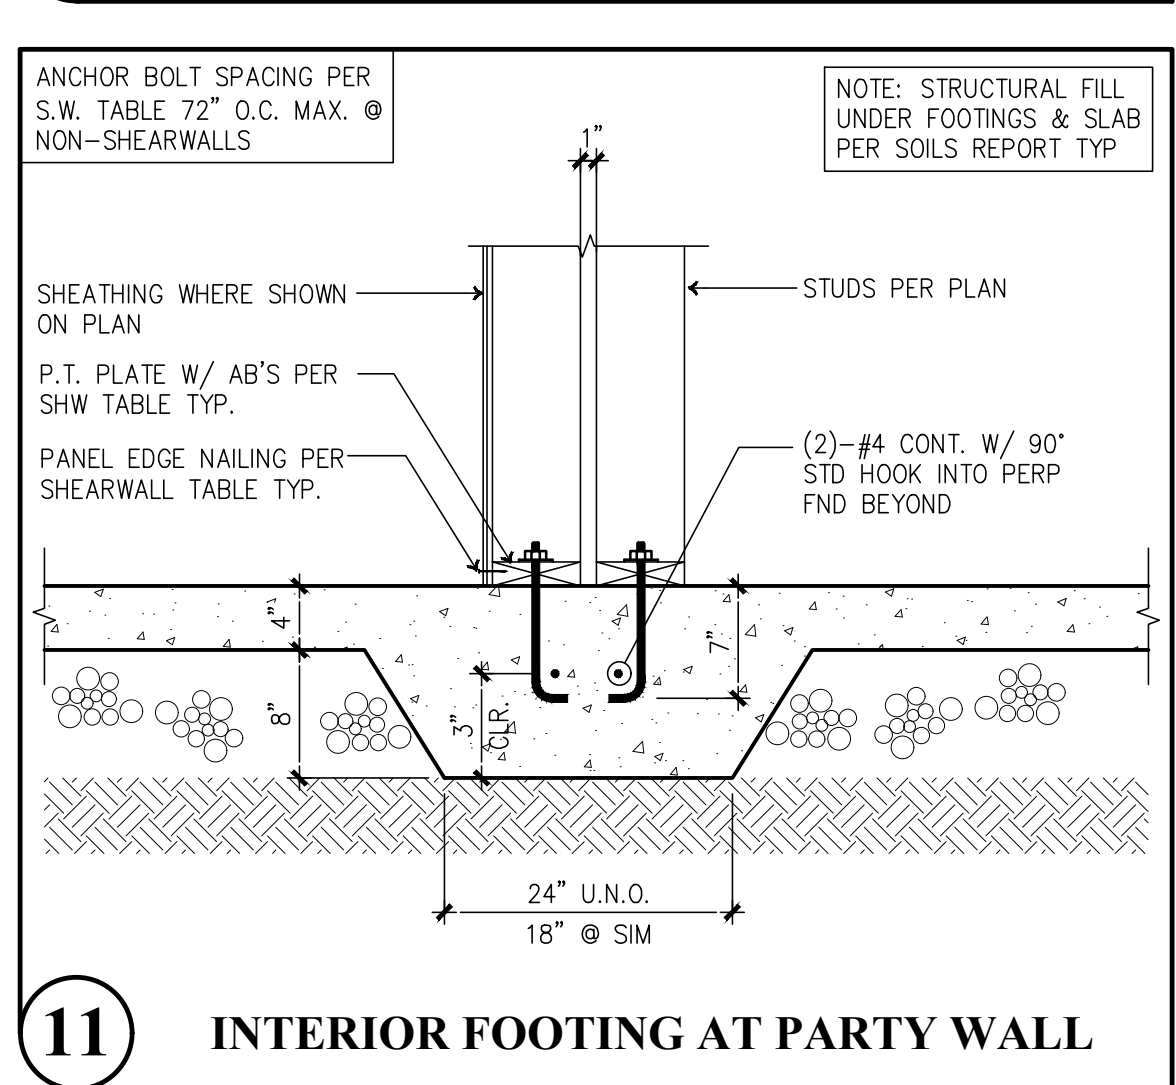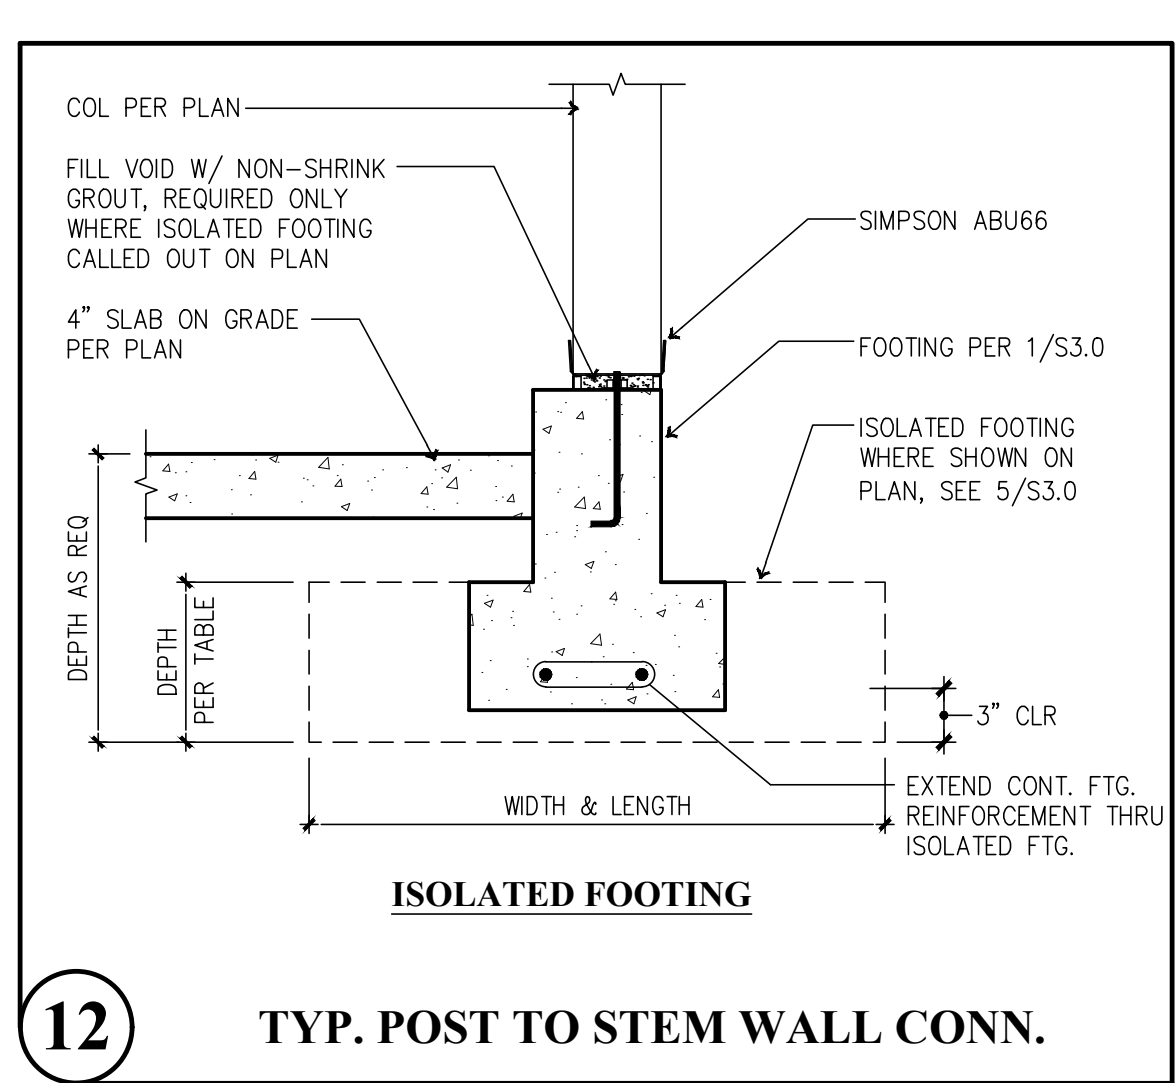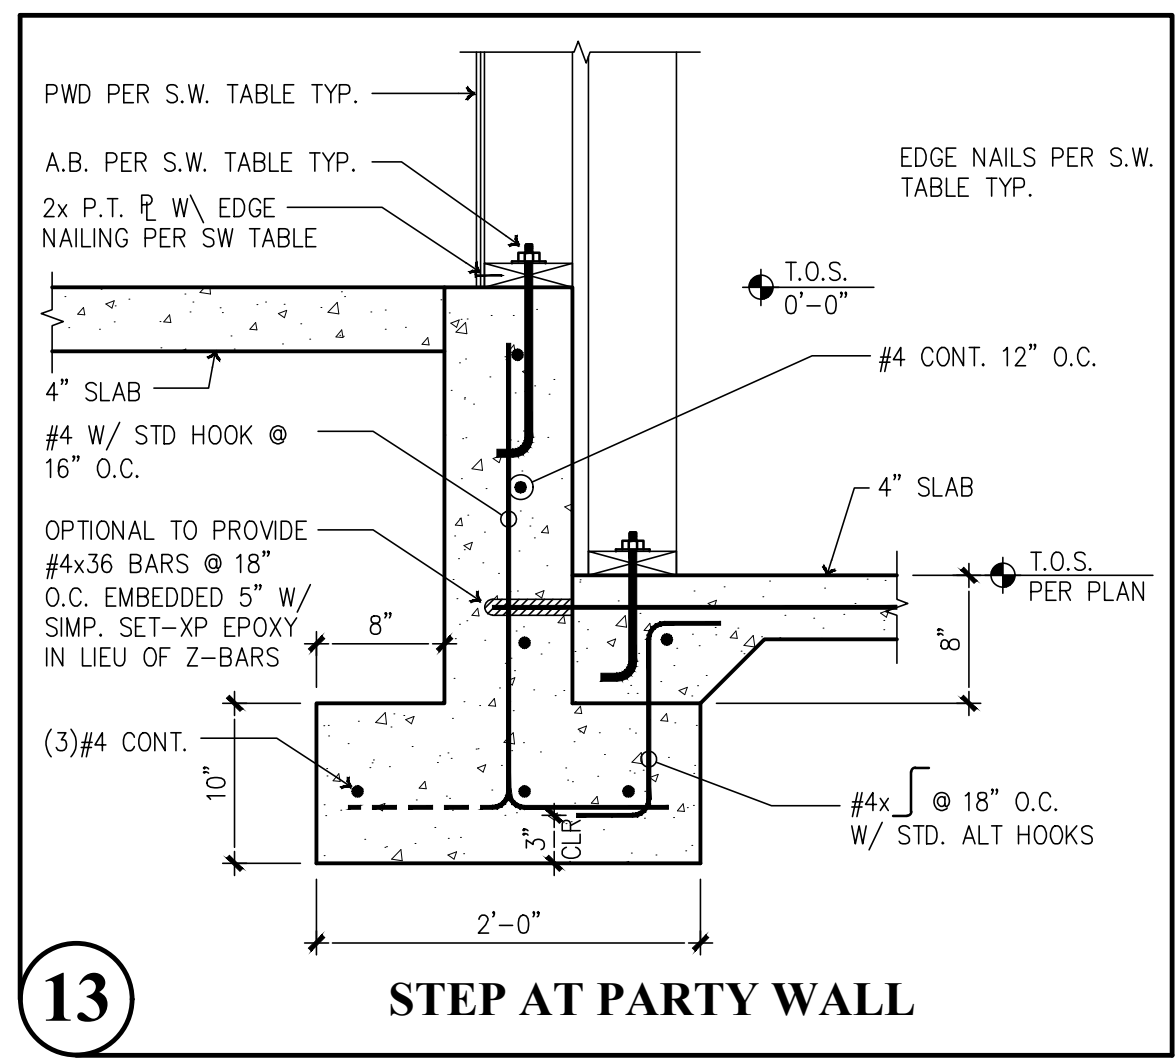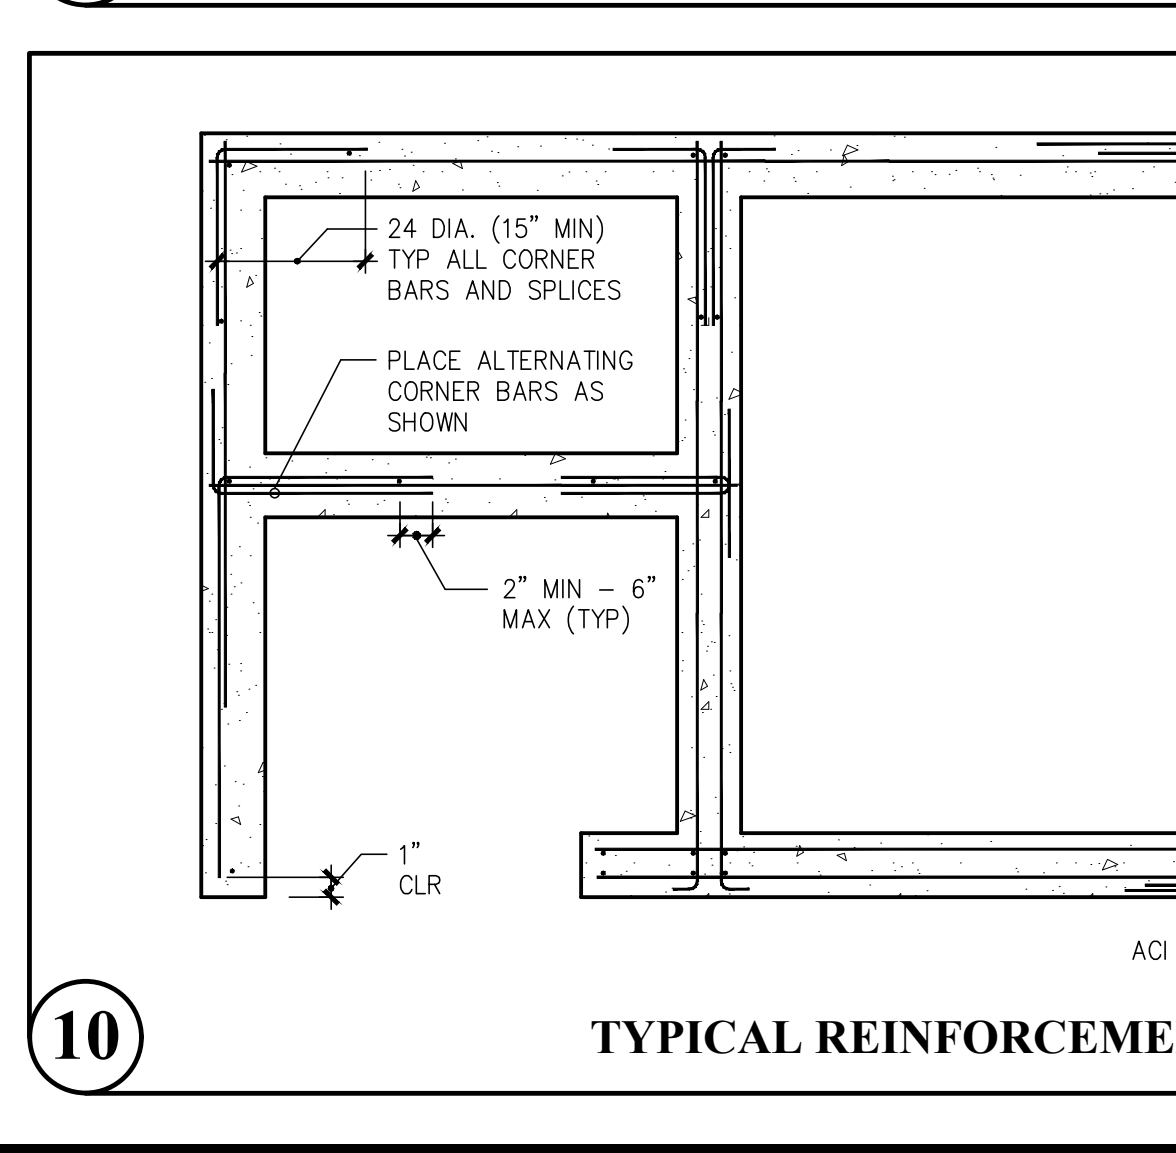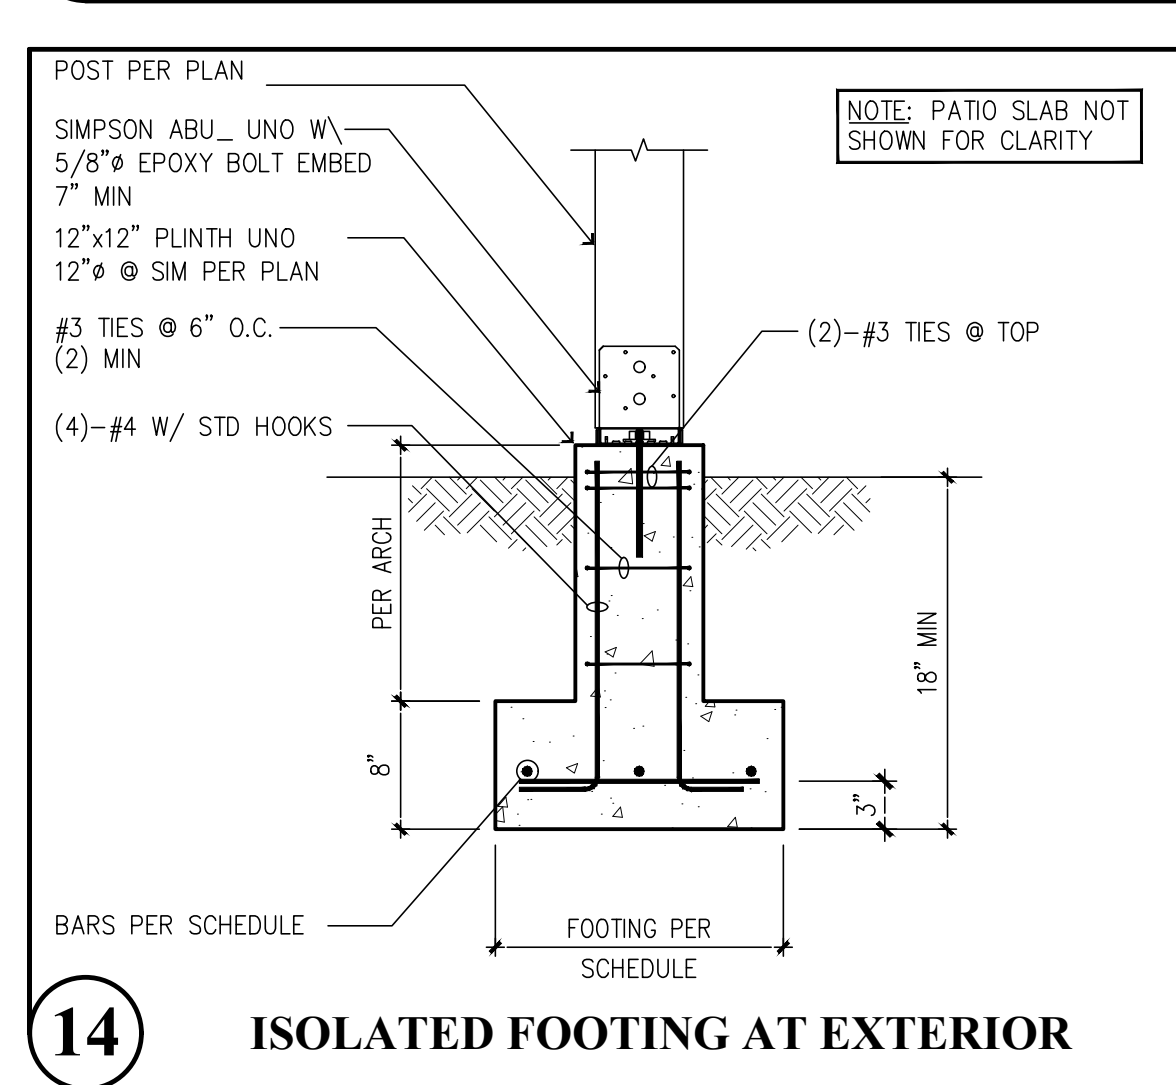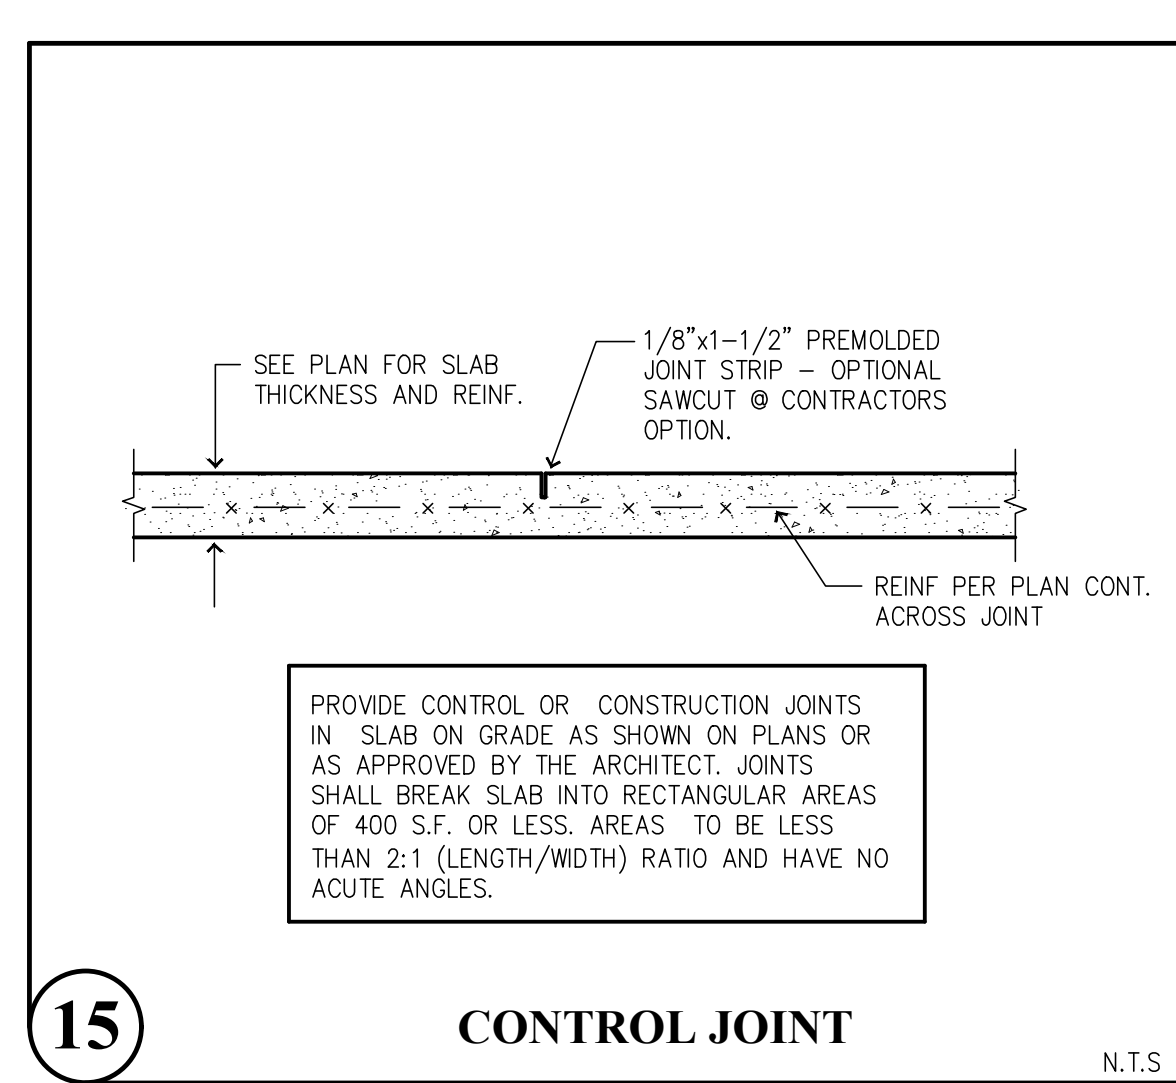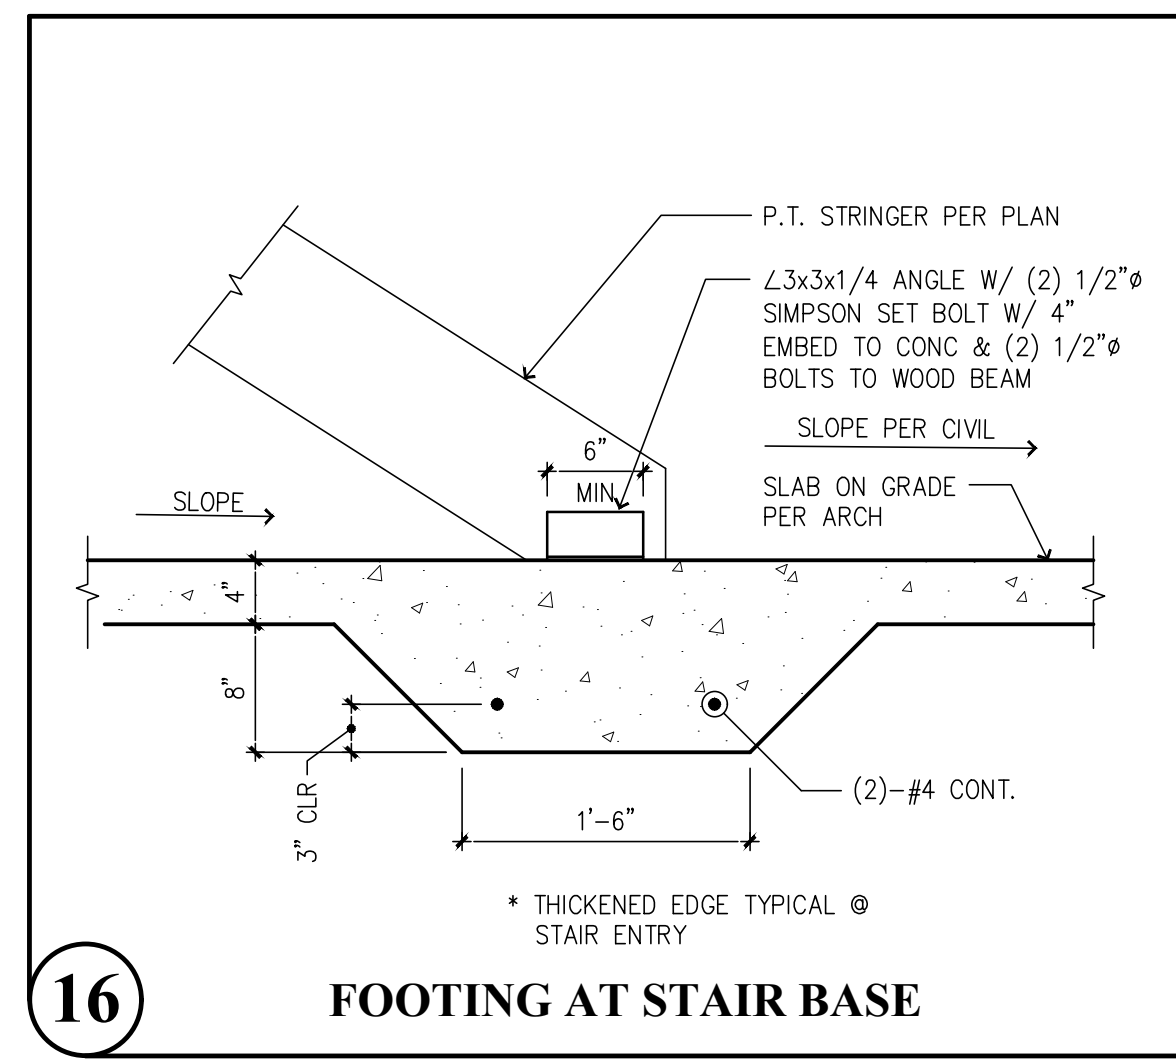

Bradley Heights Apartments
 202 27th Ave SE
 Puyallup, Washington

Solutions 4 Structures
 A Structural Engineering Corporation

PROJECT NO. : 23.007
 DESIGNED BY : TLC, OGG, MRO
 DRAWN BY : RSO
 ISSUE DATE : 2-20-24
 LATEST REV. OF DWG. SET :

SUBMITTAL SET ONLY NOT FOR CONSTRUCTION
 THESE DRAWINGS ARE SUBJECT TO REVISIONS
 PENDING LOCAL JURISDICTIONAL REVIEW.


Puyallup, Washington 98374
 Ph. 253-314-9822
 www.solutions4structures.com

Revisions to this sheet:


S3.0

PLOT DATE/TIME: 2/15/2024 - 9:48am THANK YOU FOR USING SOLUTIONS 4 STRUCTURES


CAD FILE: F:\Projects\2023 Projects\3.007 Bradley Heights\Drawings\S3.1.dwg

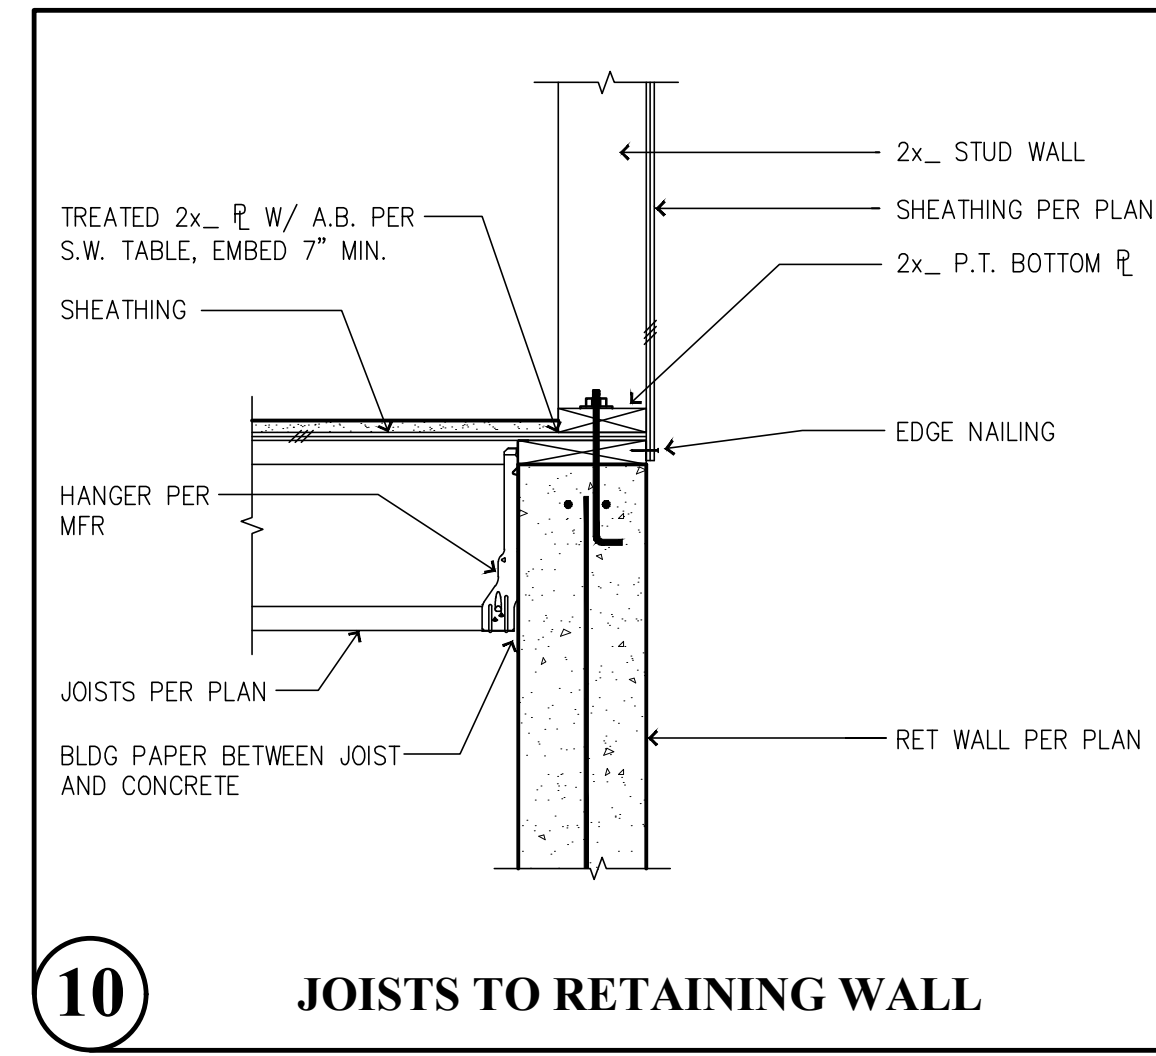


10 JOISTS TO RETAINING WALL

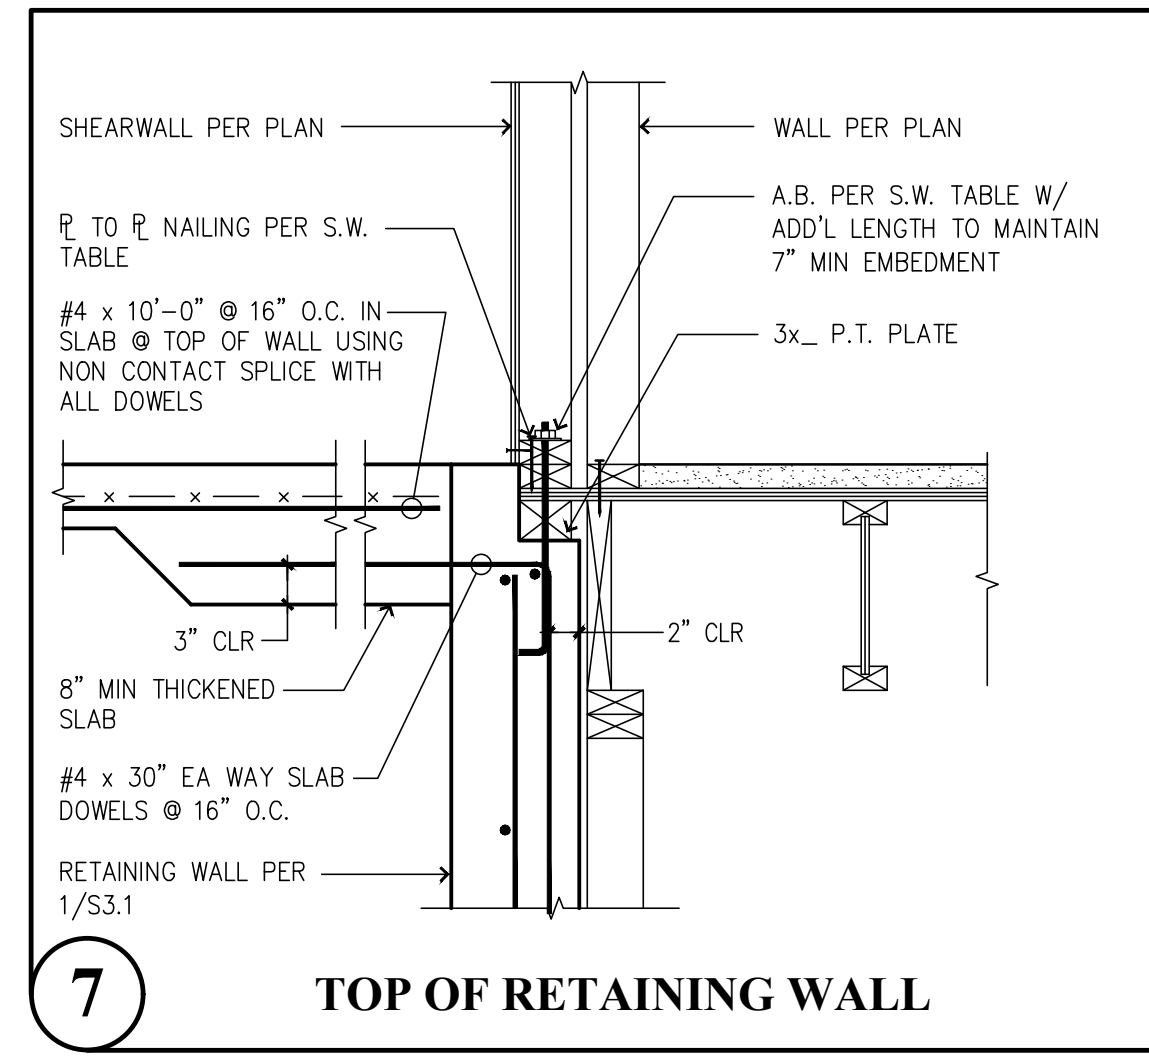


7 TOP OF RETAINING WALL

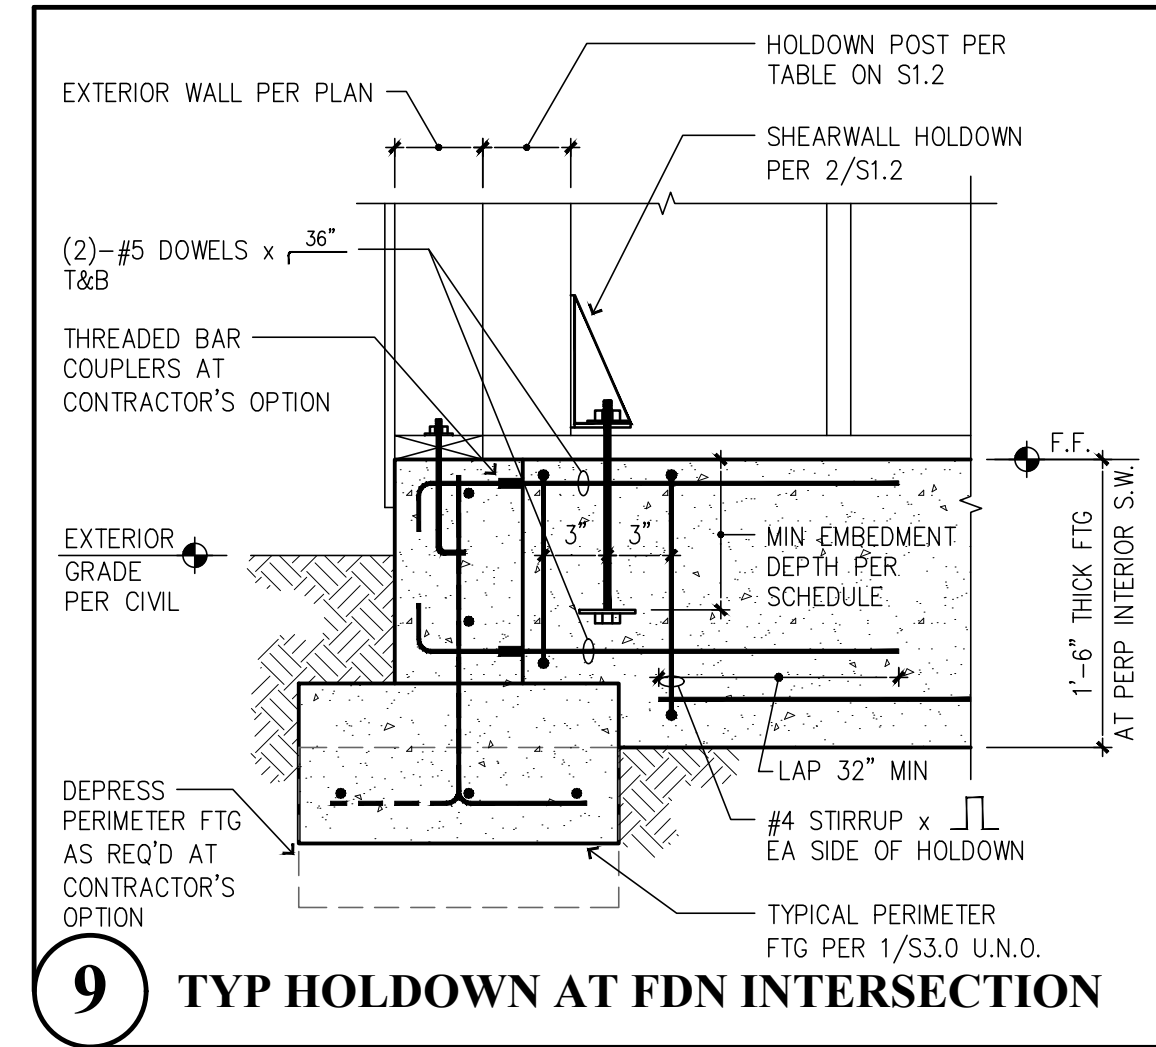


9 TYP HOLDOWN AT FDN INTERSECTION

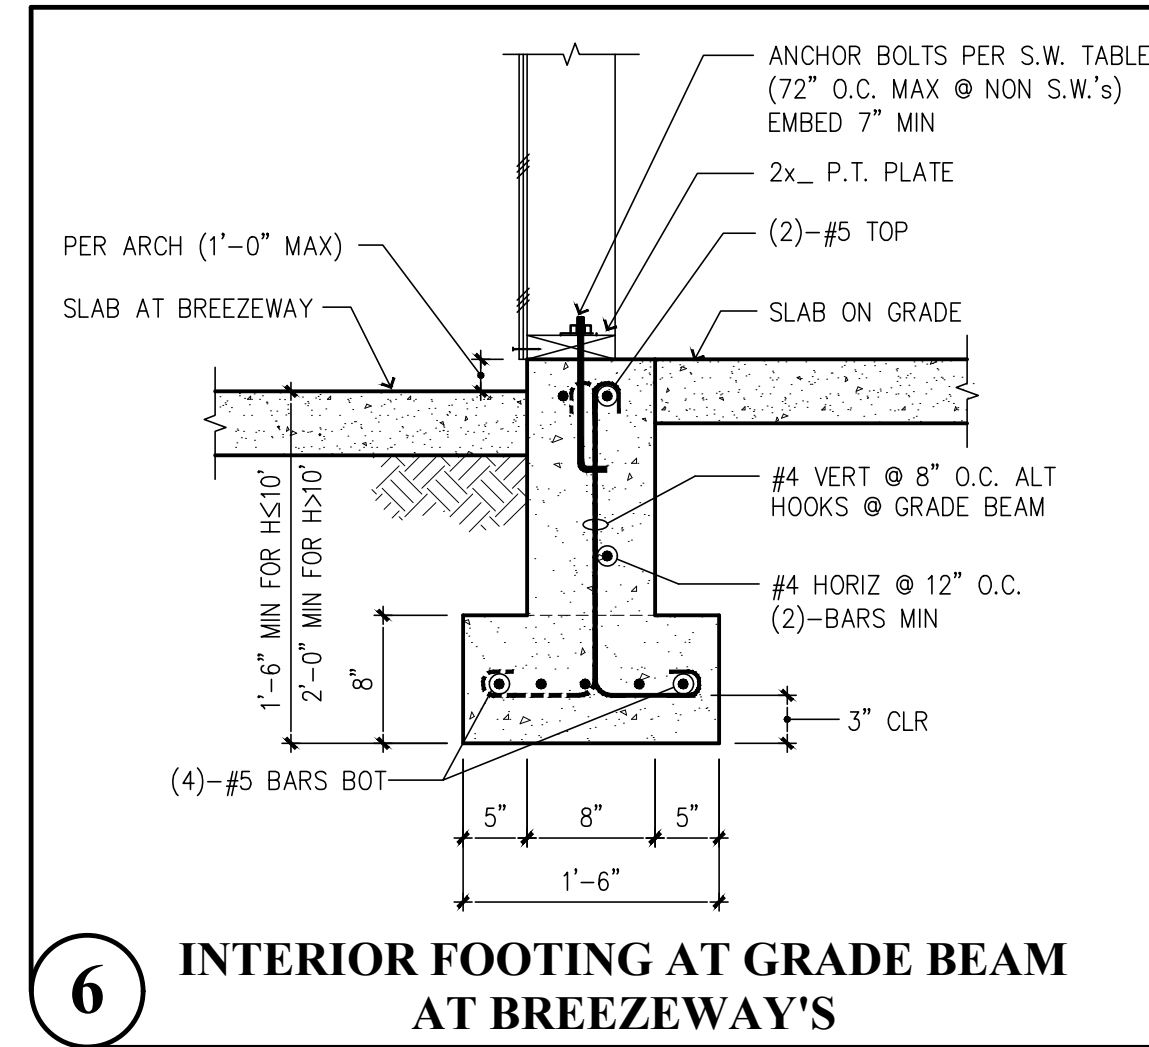


6 INTERIOR FOOTING AT GRADE BEAM AT BREEZEWAY'S

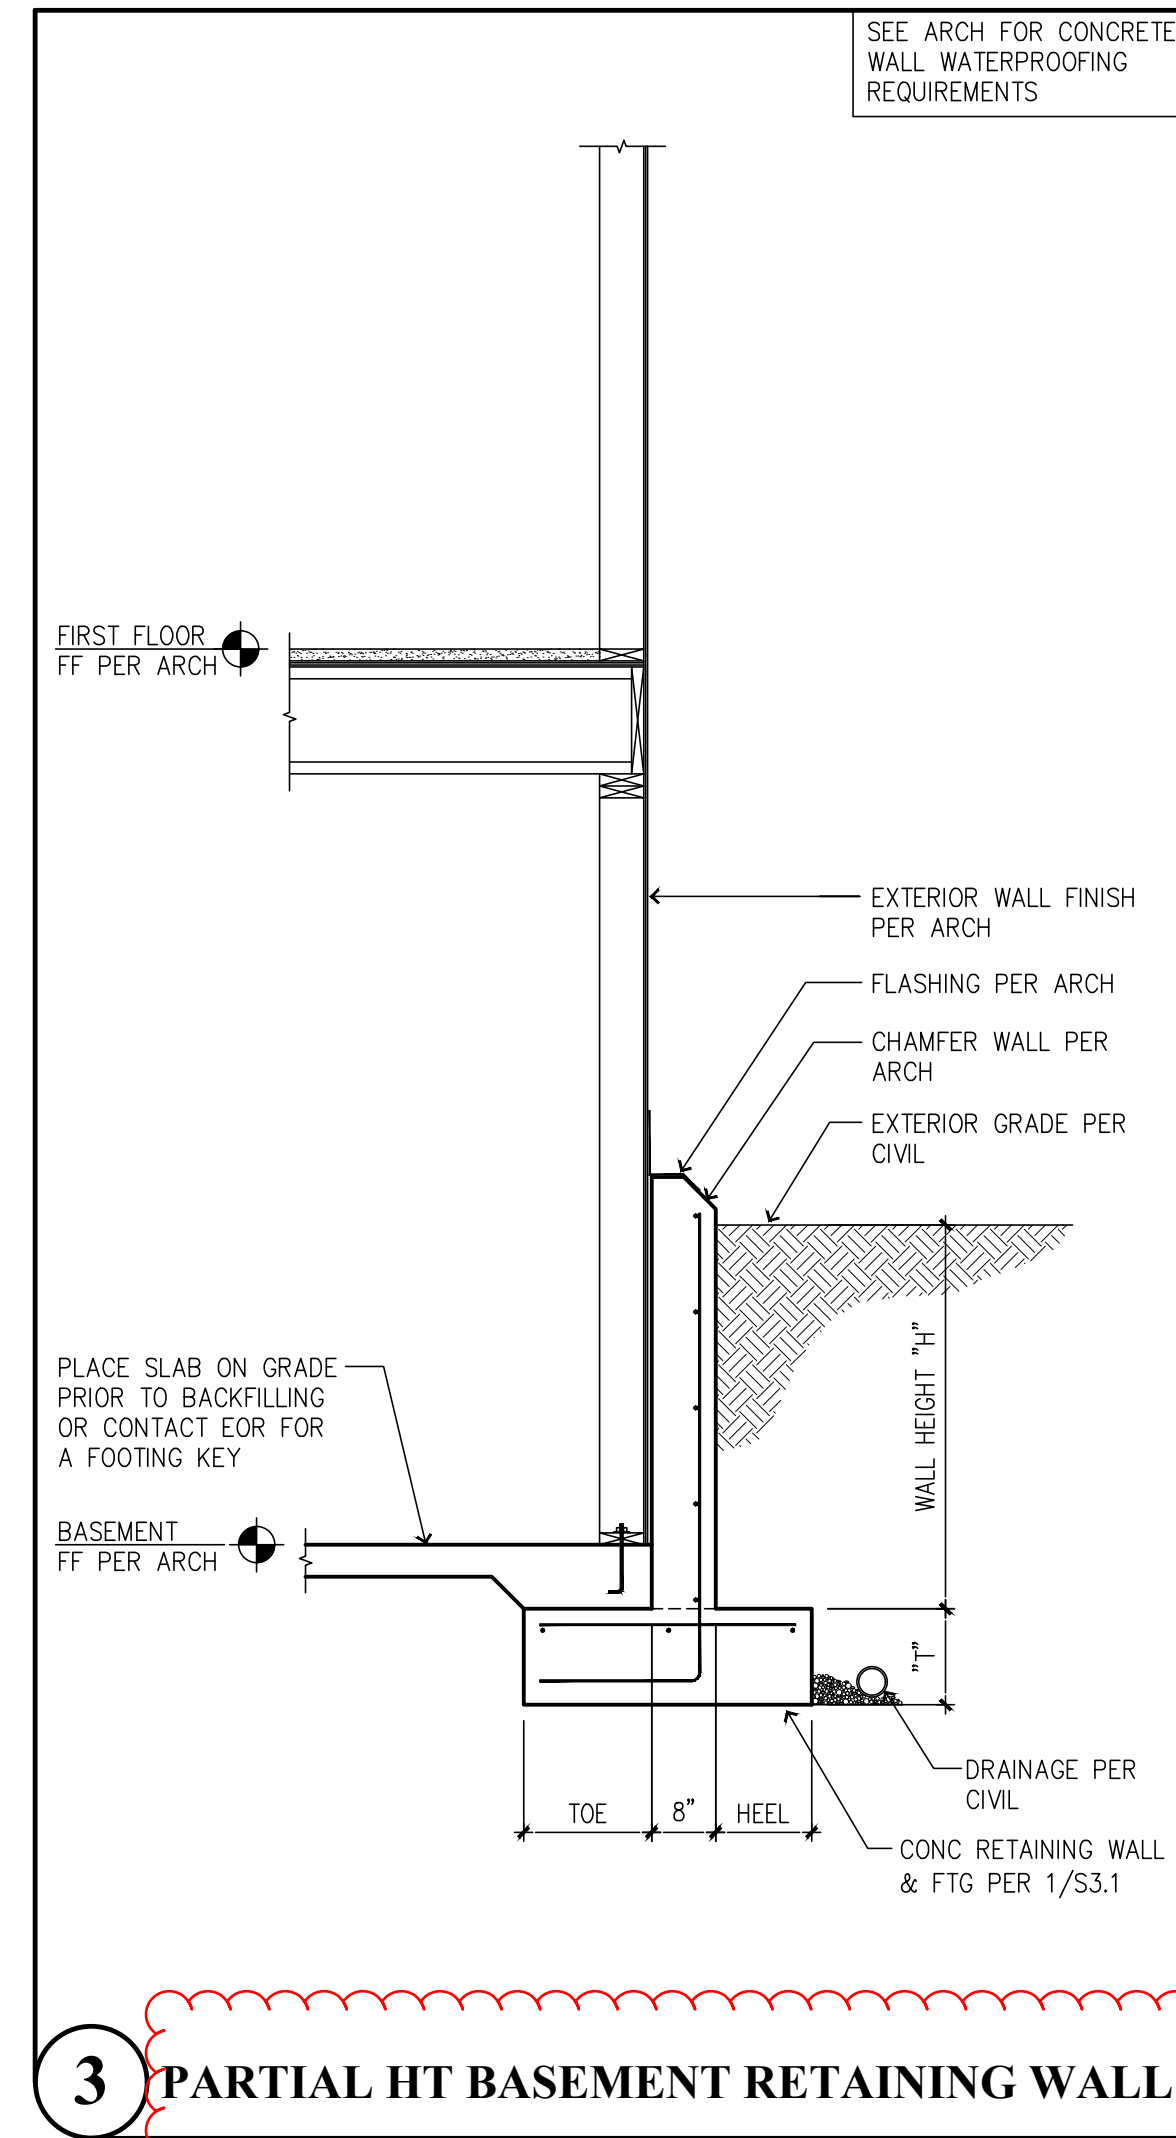


3 PARTIAL HT BASEMENT RETAINING WALL

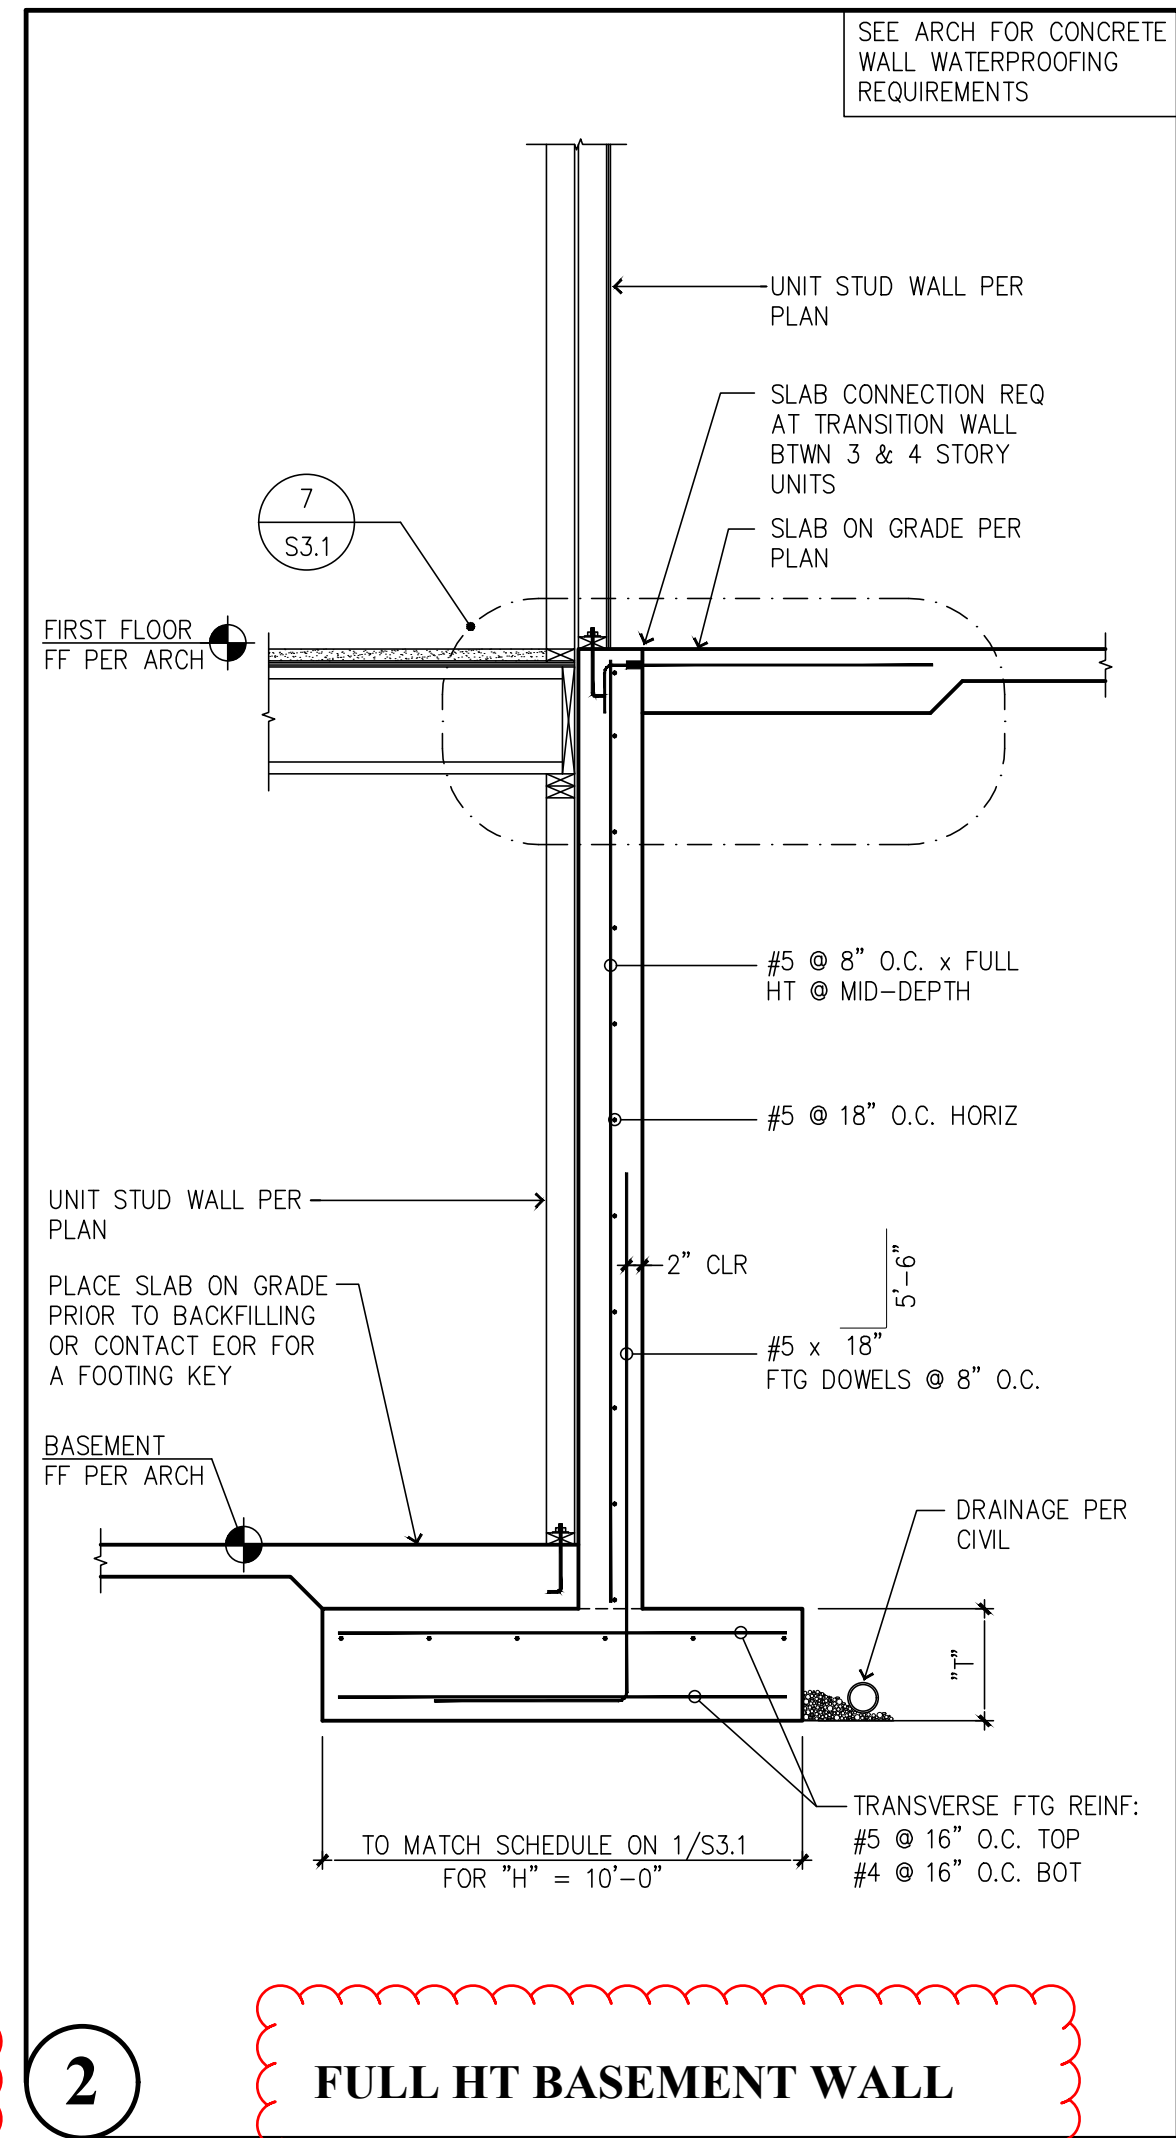

2 FULL HT BASEMENT WALL

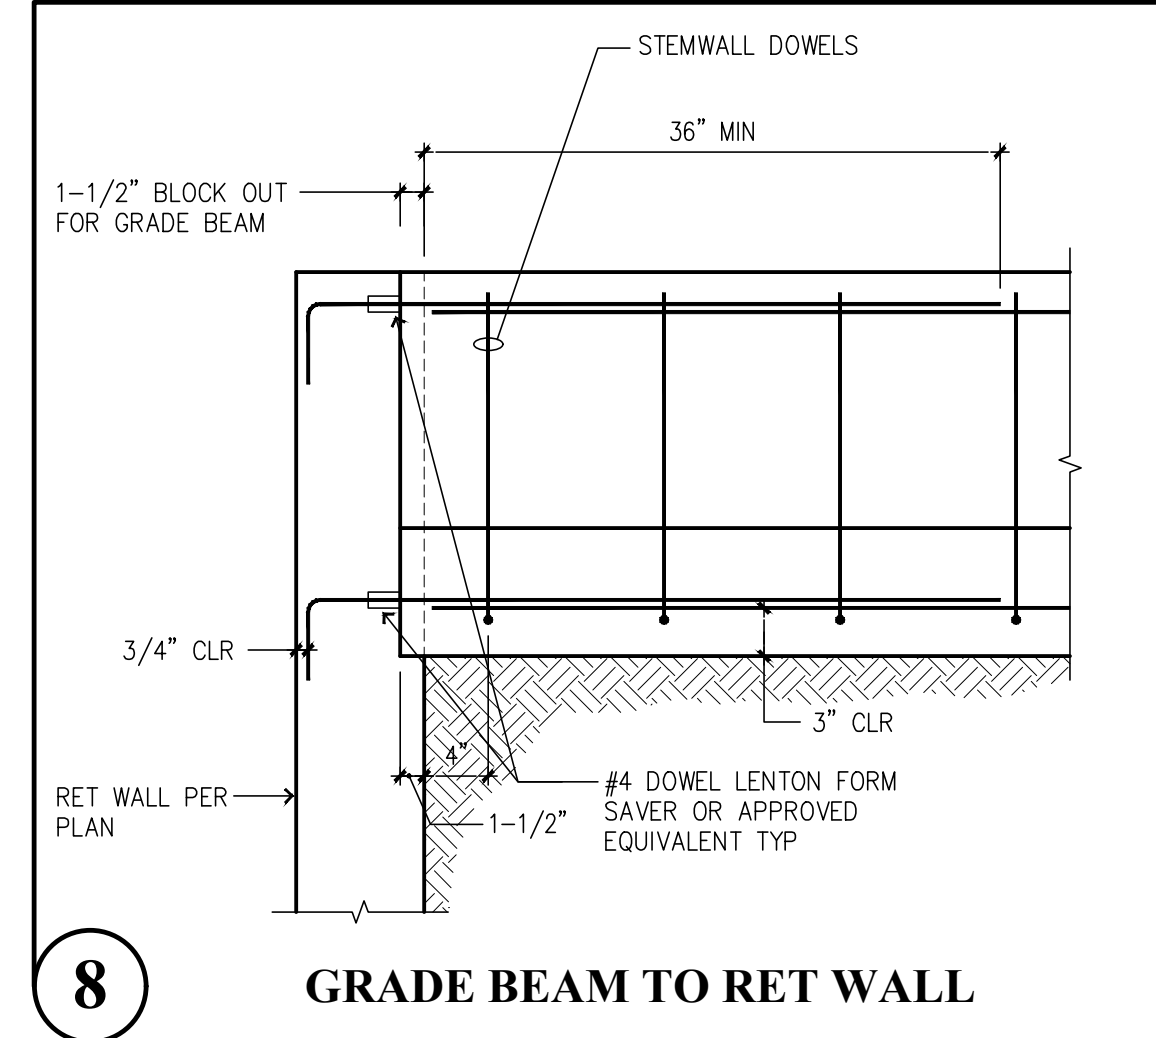


8 GRADE BEAM TO RET WALL

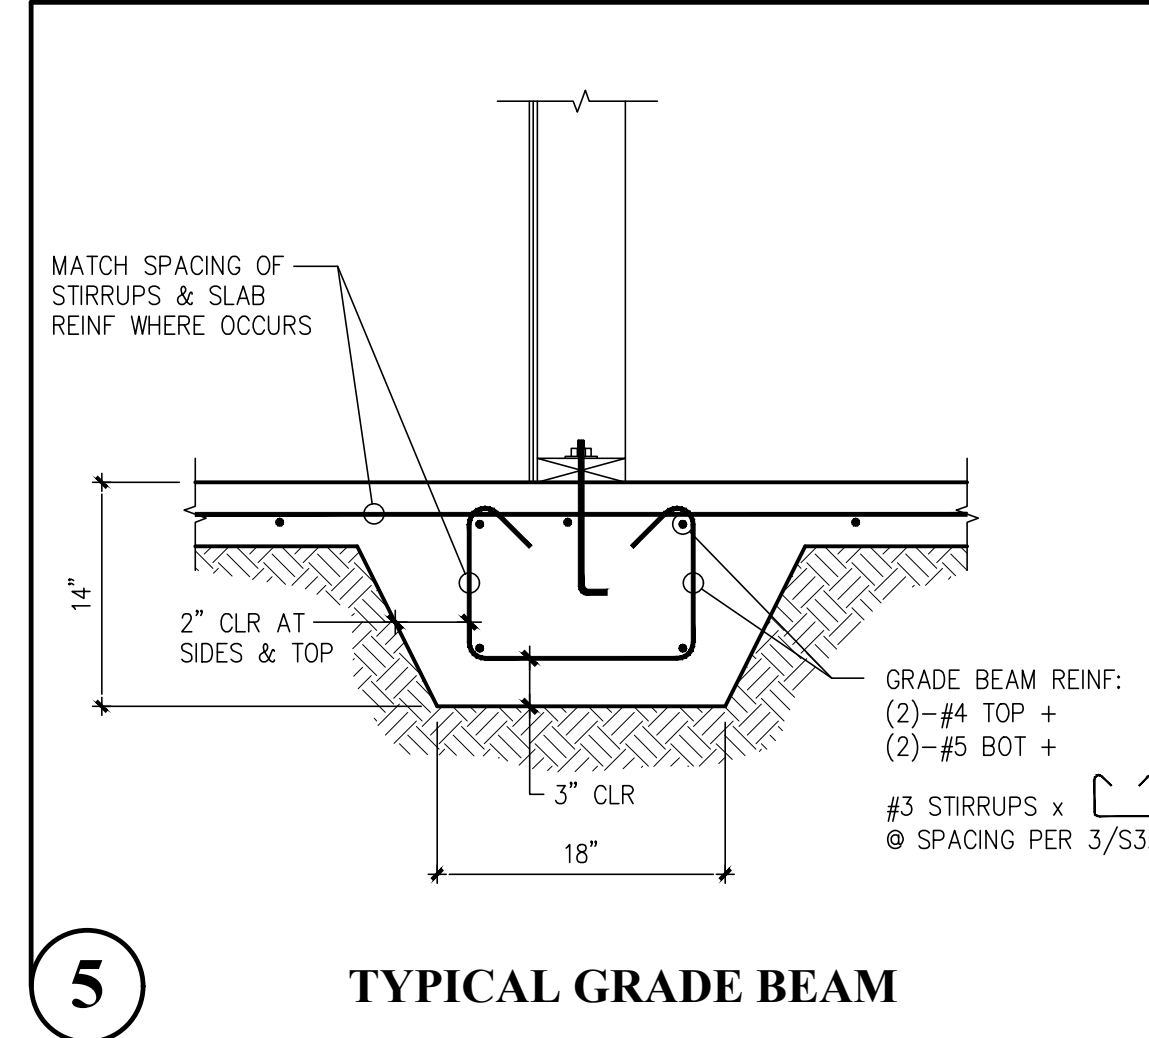


5 TYPICAL GRADE BEAM

- DESIGN PARAMETERS**
- SOIL BEARING = 2,000 PSF
 - ACTIVE & AT REST FLUID PRESSURES PER DIAGRAM
 - PASSIVE FLUID PRESSURE = 450 PCF
 - 20 PSF (MAX) LIVE LOAD SURCHARGE, HORIZ.
 - 12" PSF (MAX) SEISMIC SURCHARGE, HORIZ.
 - SOIL FRICTION COEF. = 0.53
 - SOIL UNIT WEIGHT = 120 PCF (MIN)
 - DRAINAGE SYSTEM BY OTHERS. HYDROSTATIC PRESSURES BEHIND THE WALL ARE NOT PERMITTED
- NOTES**
- PROVIDE CORNER STEEL @ FTG CORNERS & INTERSECTIONS. USE 36"x36" ELBOW STEEL TO LAP HORIZ REINF, MATCH SIZE.
 - CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND HEIGHTS PRIOR TO CONSTRUCTION. NOTIFY ENGR/OWNER OF ANY DISCREPANCIES.
 - REINFORCEMENT GRADES SHALL TYPICALLY BE : GRADE 60
 - CONCRETE STRENGTH SHALL BE A MINIMUM OF 2500 PSI PRIOR TO BACKFILL.

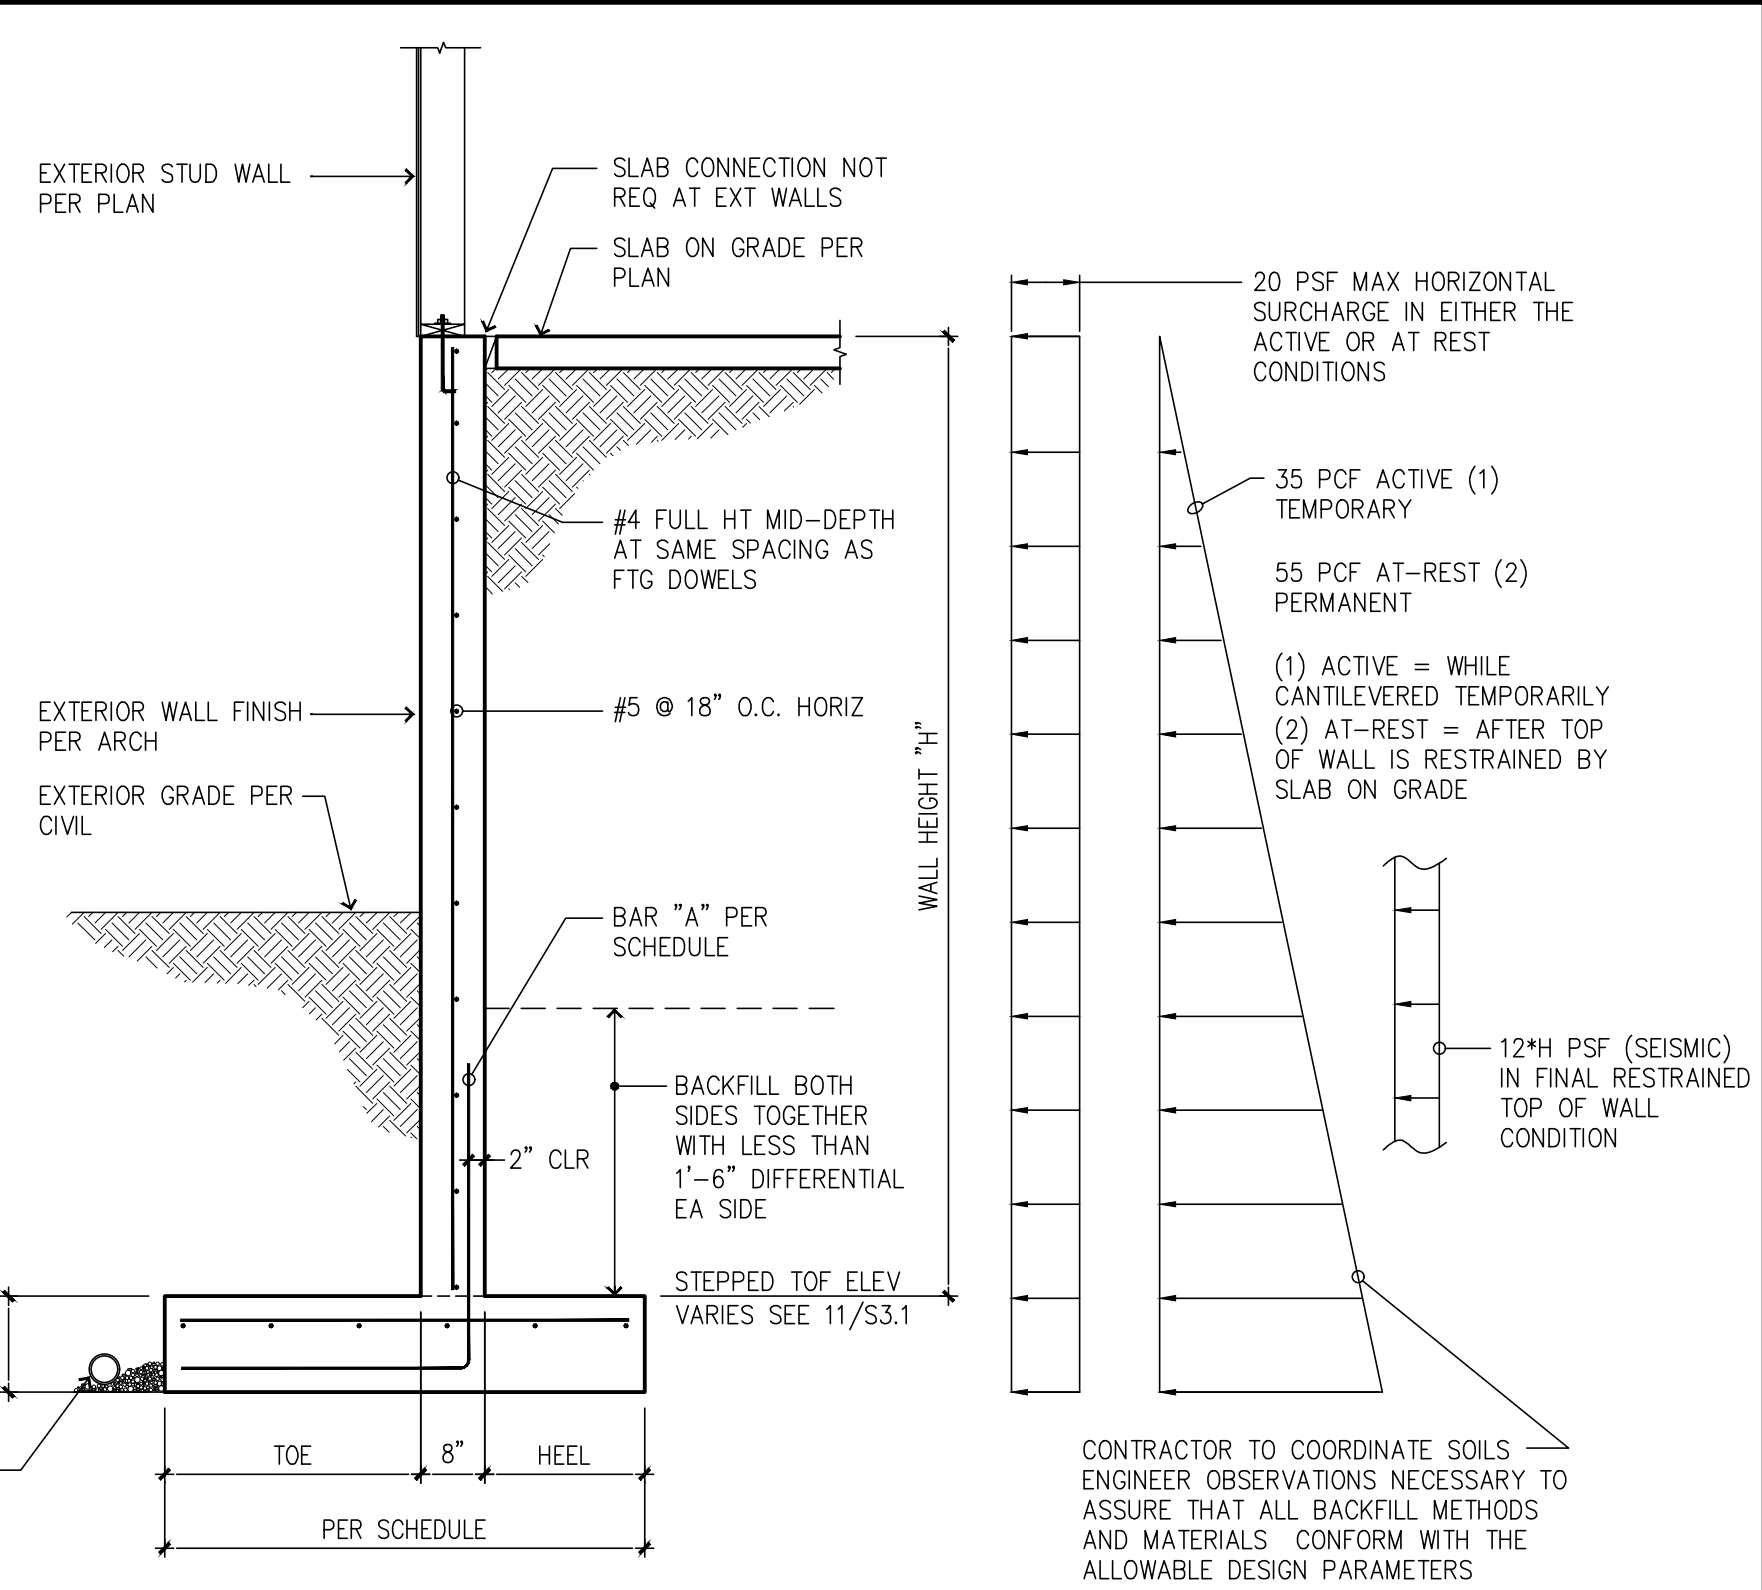


WALL HEIGHT MAX	FOOTING DIMENSIONS				"T" THKNS	BAR "A"		BAR "B"	
	TOE	STEM	HEEL	TOTAL		SIZE & SPACING	VERT LEG	HORIZ LEG	SIZE & SPACING
10'-0"	2'-8"	8"	1'-8"	5'-0"	14"	#5 @ 10" O.C.	5'-6"	2'-10"	#4 @ 10" O.C.
8'-0"	2'-0"	8"	1'-4"	4'-0"	12"	#5 @ 12" O.C.	4'-6"	2'-2"	#4 @ 12" O.C.
6'-0"	1'-4"	8"	1'-0"	3'-0"	12"	#4 @ 12" O.C.	FULL HT	1'-6"	#4 @ 12" O.C.
4'-0"	0'-8"	8"	0'-8"	2'-0"	10"	#4 @ 16" O.C.	FULL HT	0'-10"	#4 @ 16" O.C.


1 STEPPED BASEMENT WALL SCHEDULE

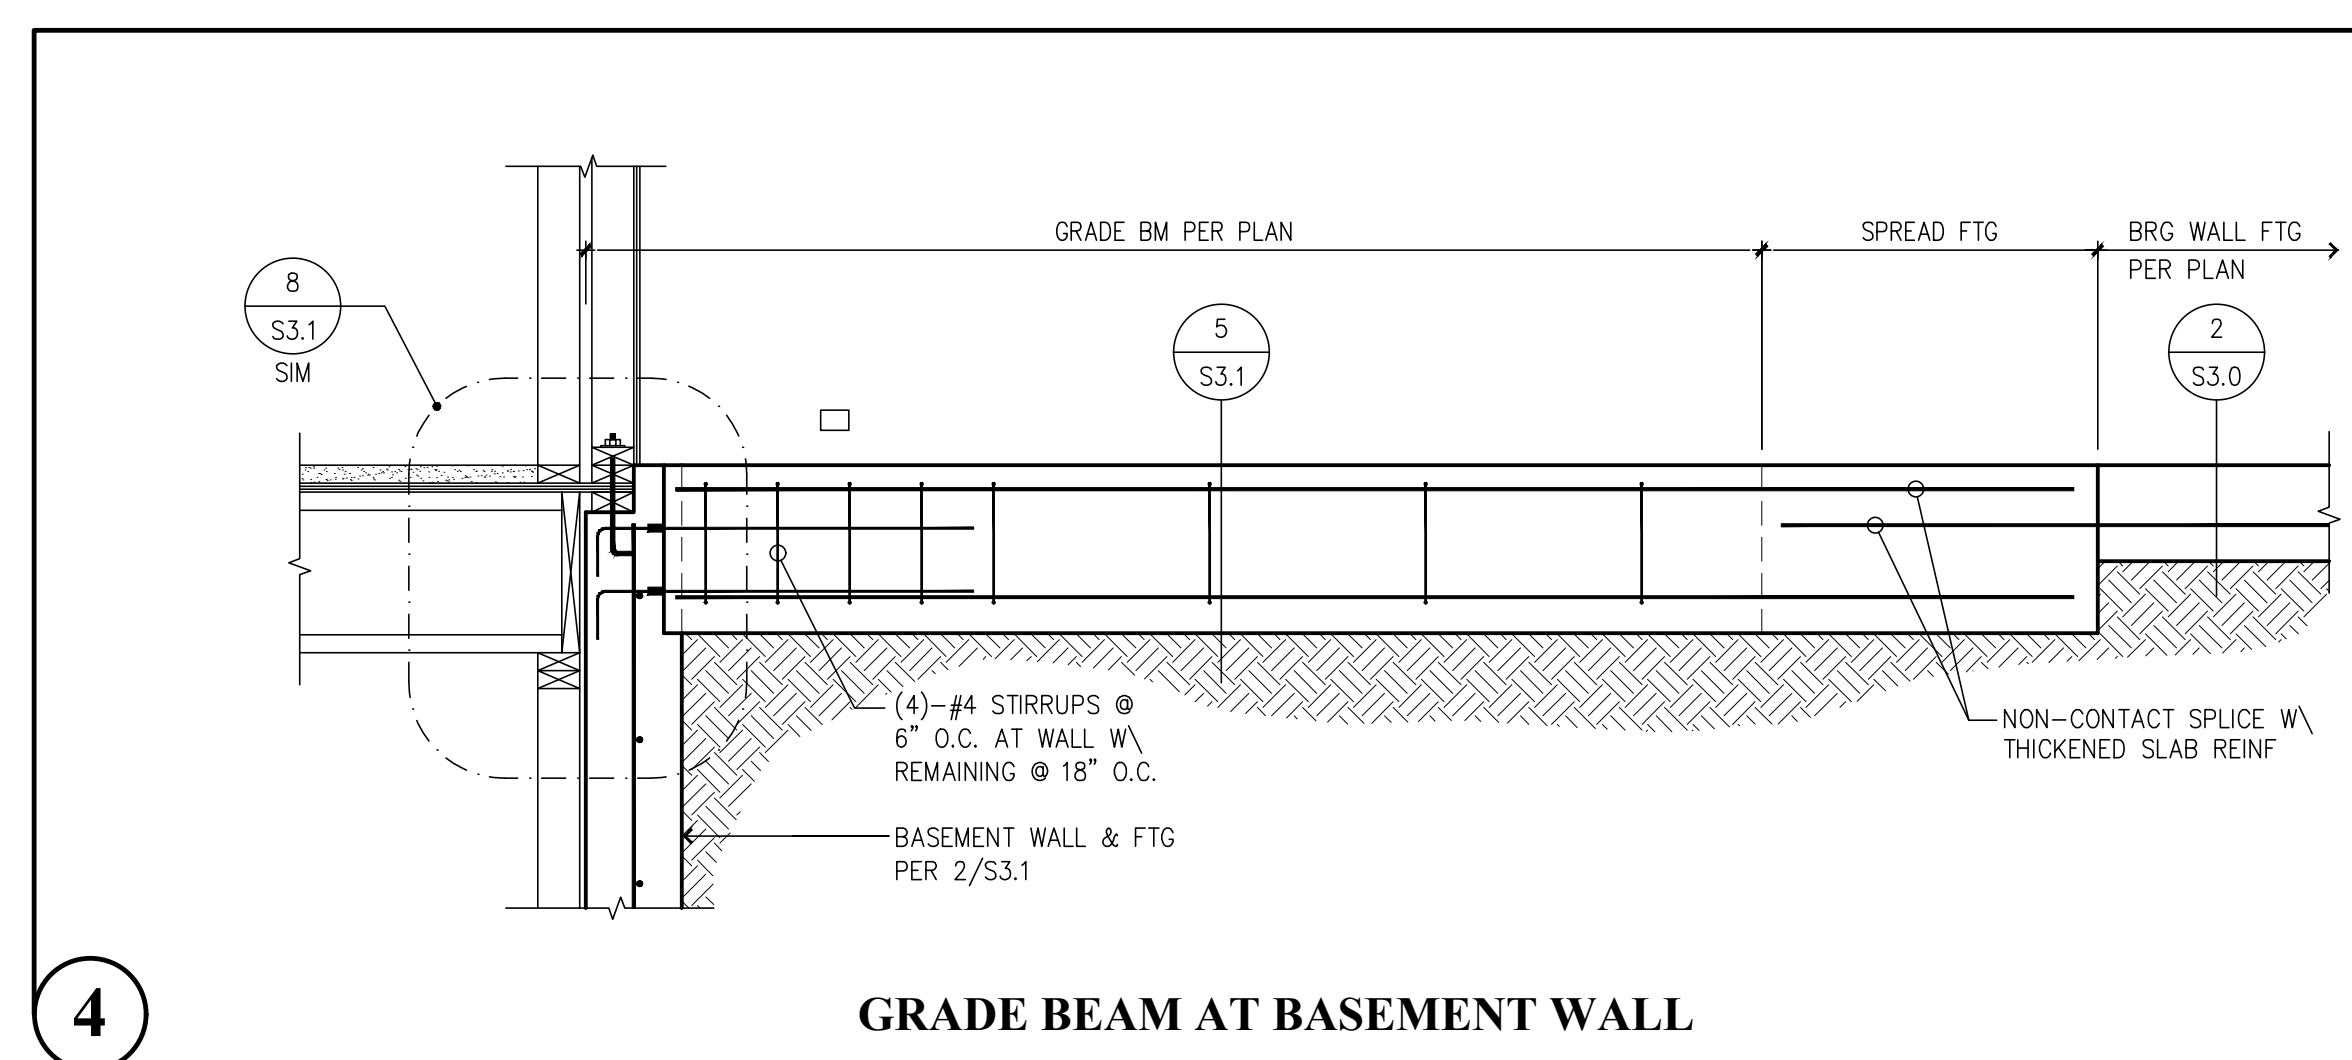

4 GRADE BEAM AT BASEMENT WALL

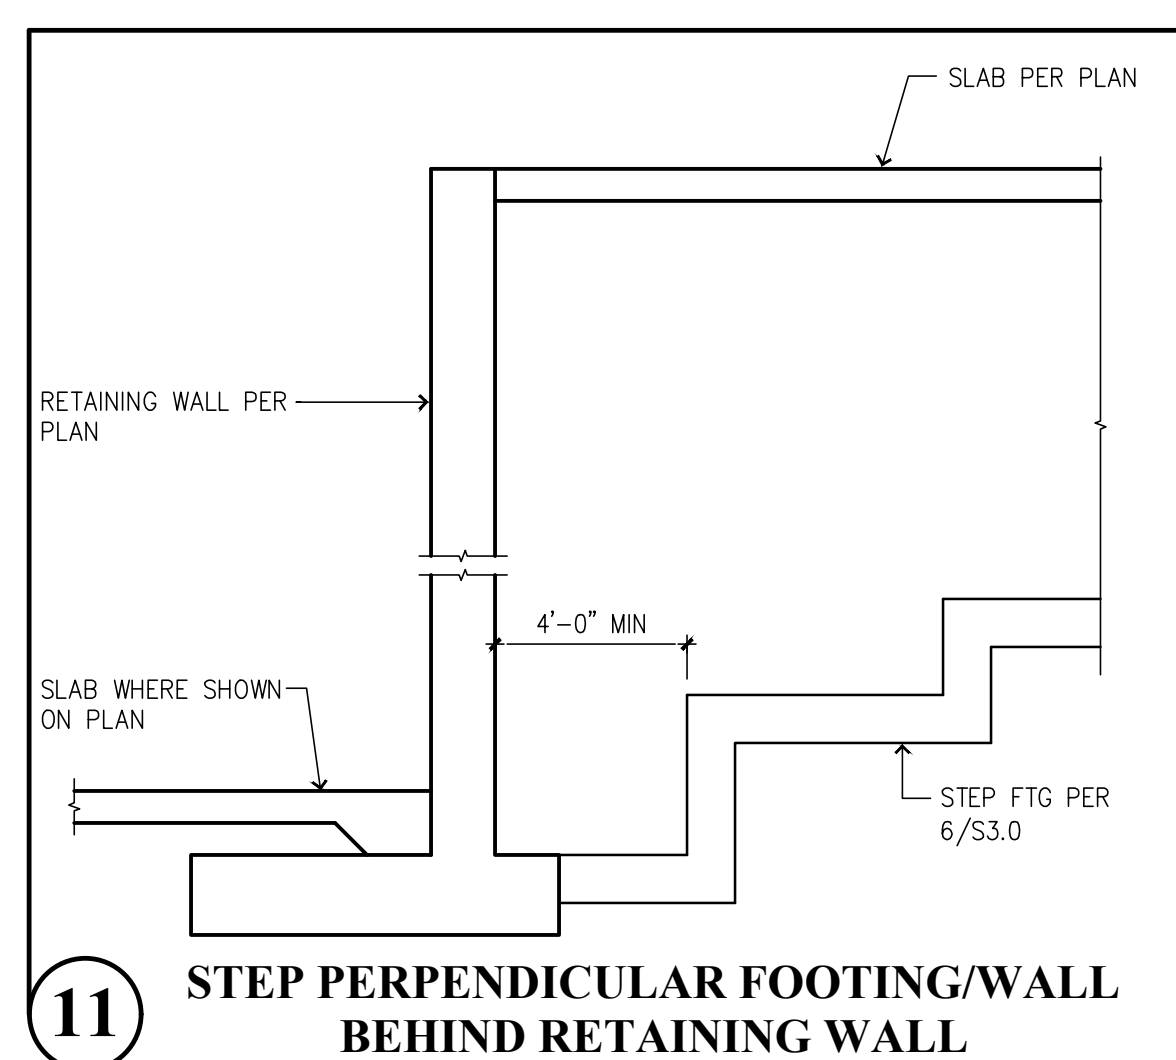

11 STEP PERPENDICULAR FOOTING/WALL BEHIND RETAINING WALL

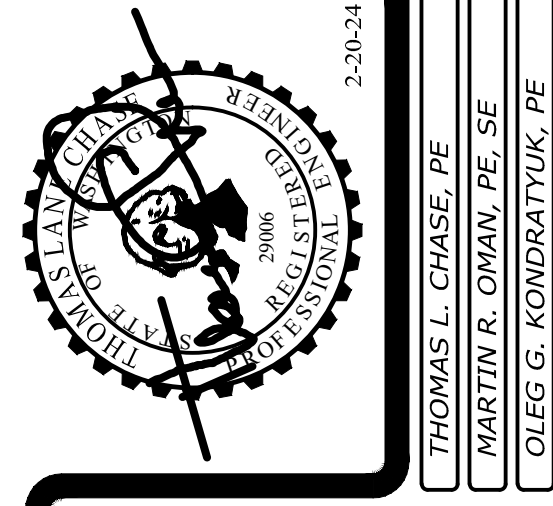

Revisions to this sheet:

Bradley Heights Apartments
202 27th Ave SE
Puyallup, Washington

Solutions 4 Structures
A Structural Engineering Corporation




















Puyallup, Washington 98374
Ph 253-314-9822
www.solutions4structures.com

PROJECT NO. : 23.007
DESIGNED BY : TLC, OGG, MRO
DRAWN BY : RSO
ISSUE DATE : 2-20-24
LATEST REV. OF DWG. SET :

SUBMITTAL SET ONLY NOT FOR CONSTRUCTION
THESE DRAWINGS ARE SUBJECT TO REVISIONS
PENDING LOCAL JURISDICTIONAL REVIEW.

CAD FILE: F:\Projects\2023\Projects\23.007 Bradley Heights\Drawings\54.0.dwg

PLOT DATE/TIME: 2/15/2024 - 9:49am THANK YOU FOR USING SOLUTIONS 4 STRUCTURES

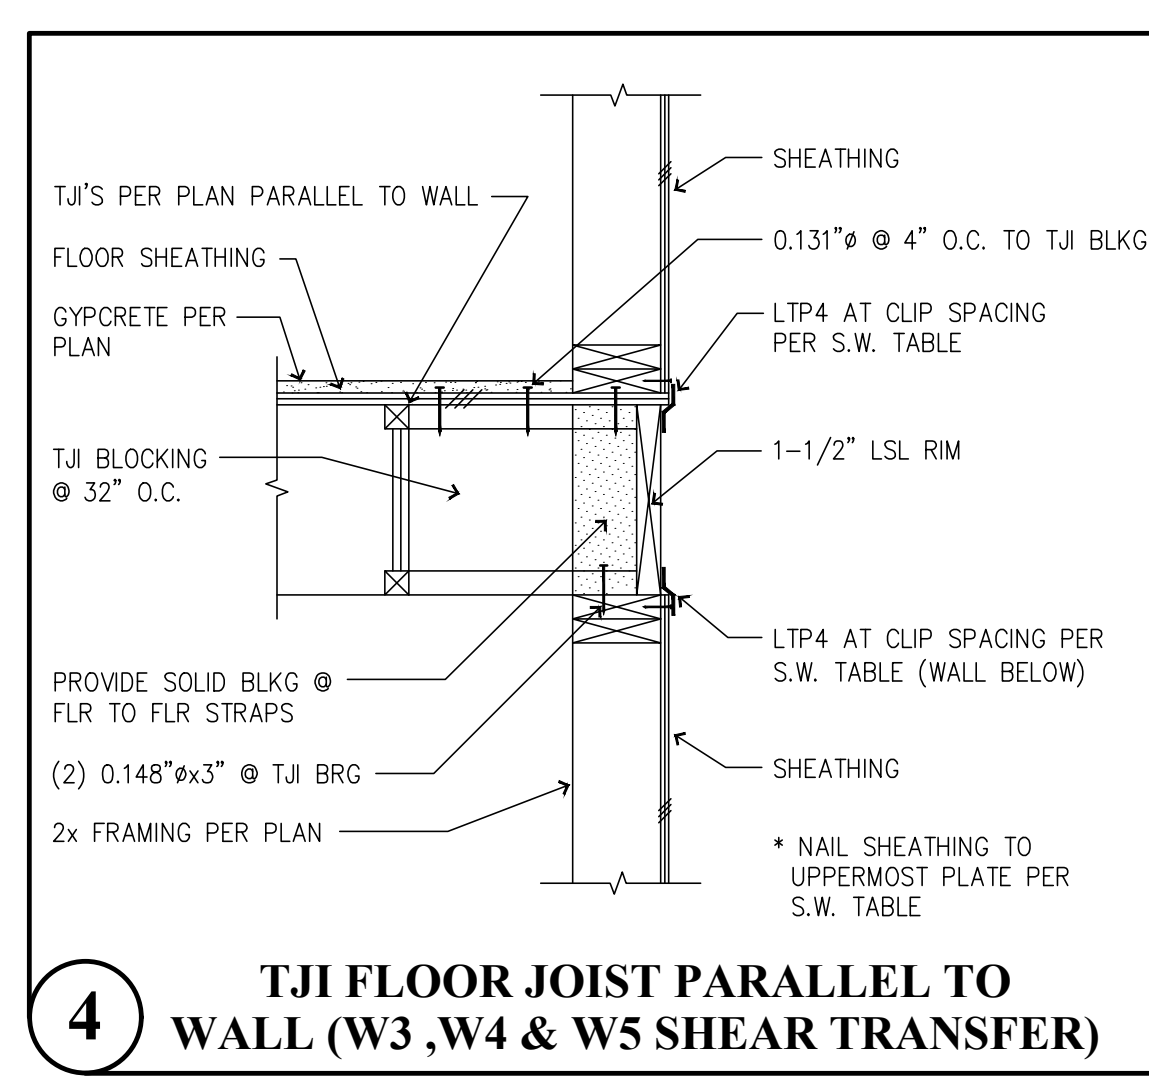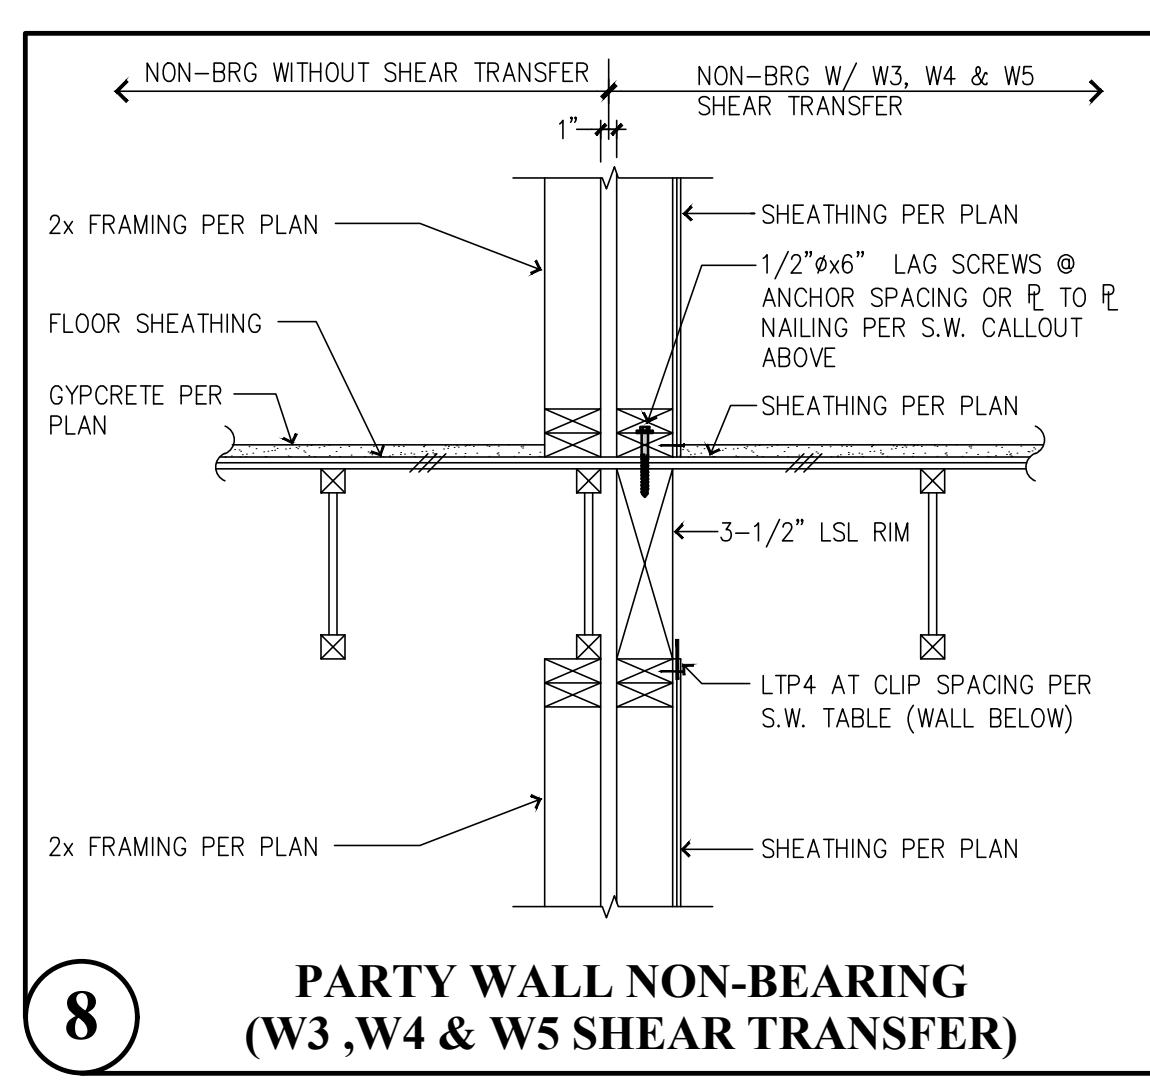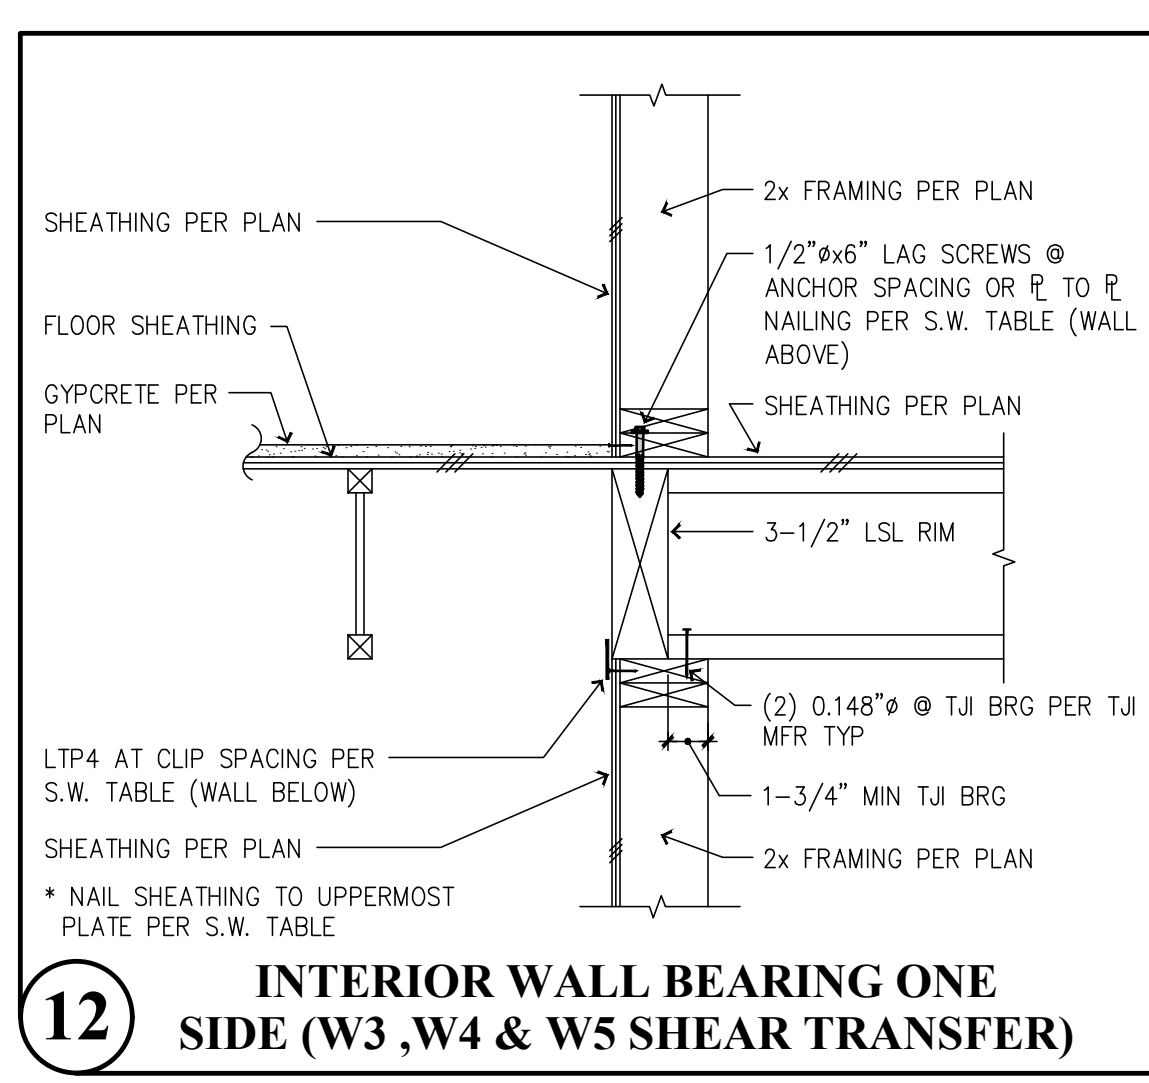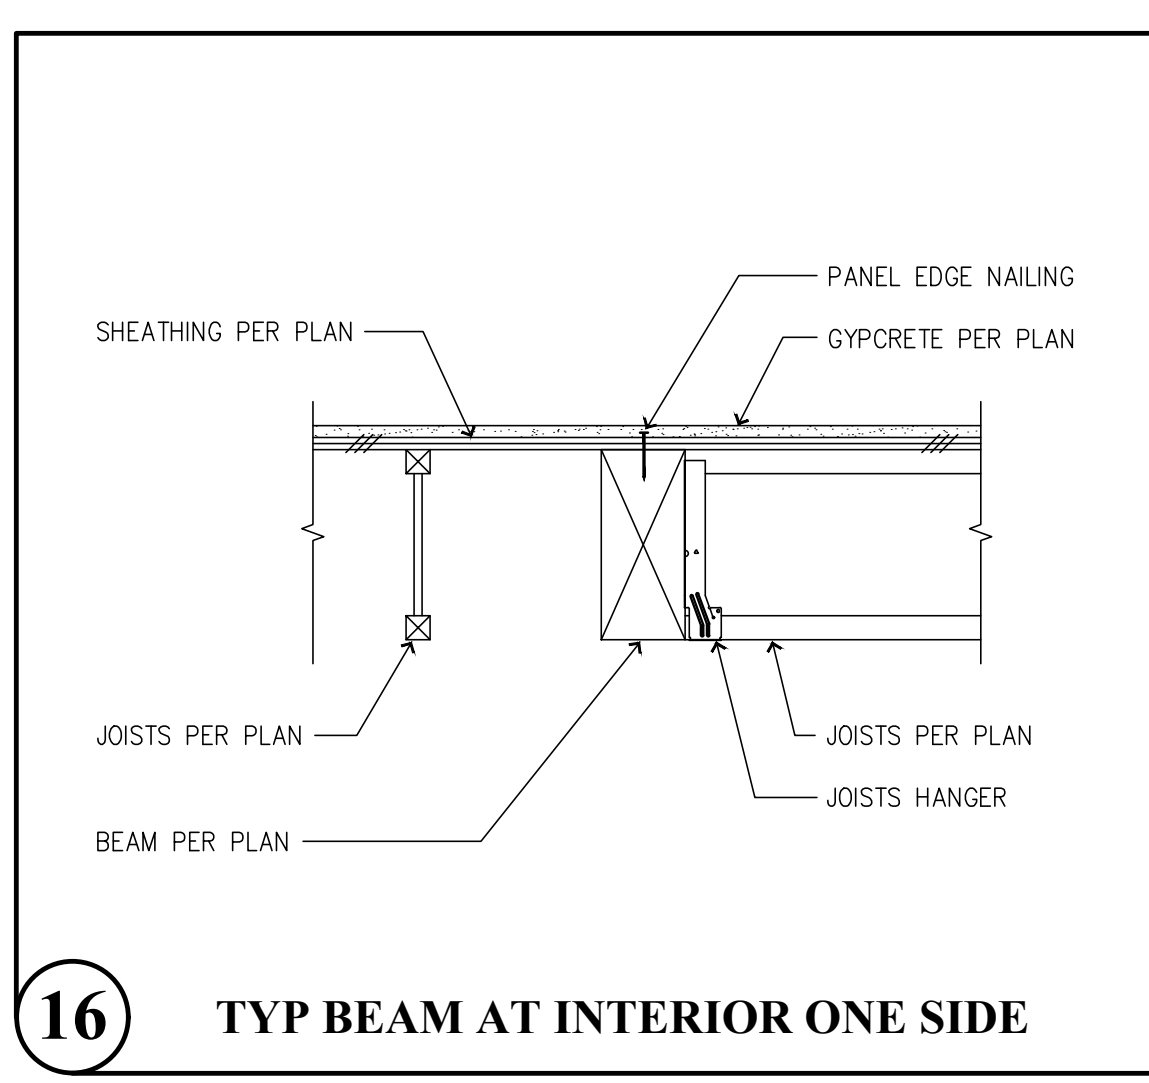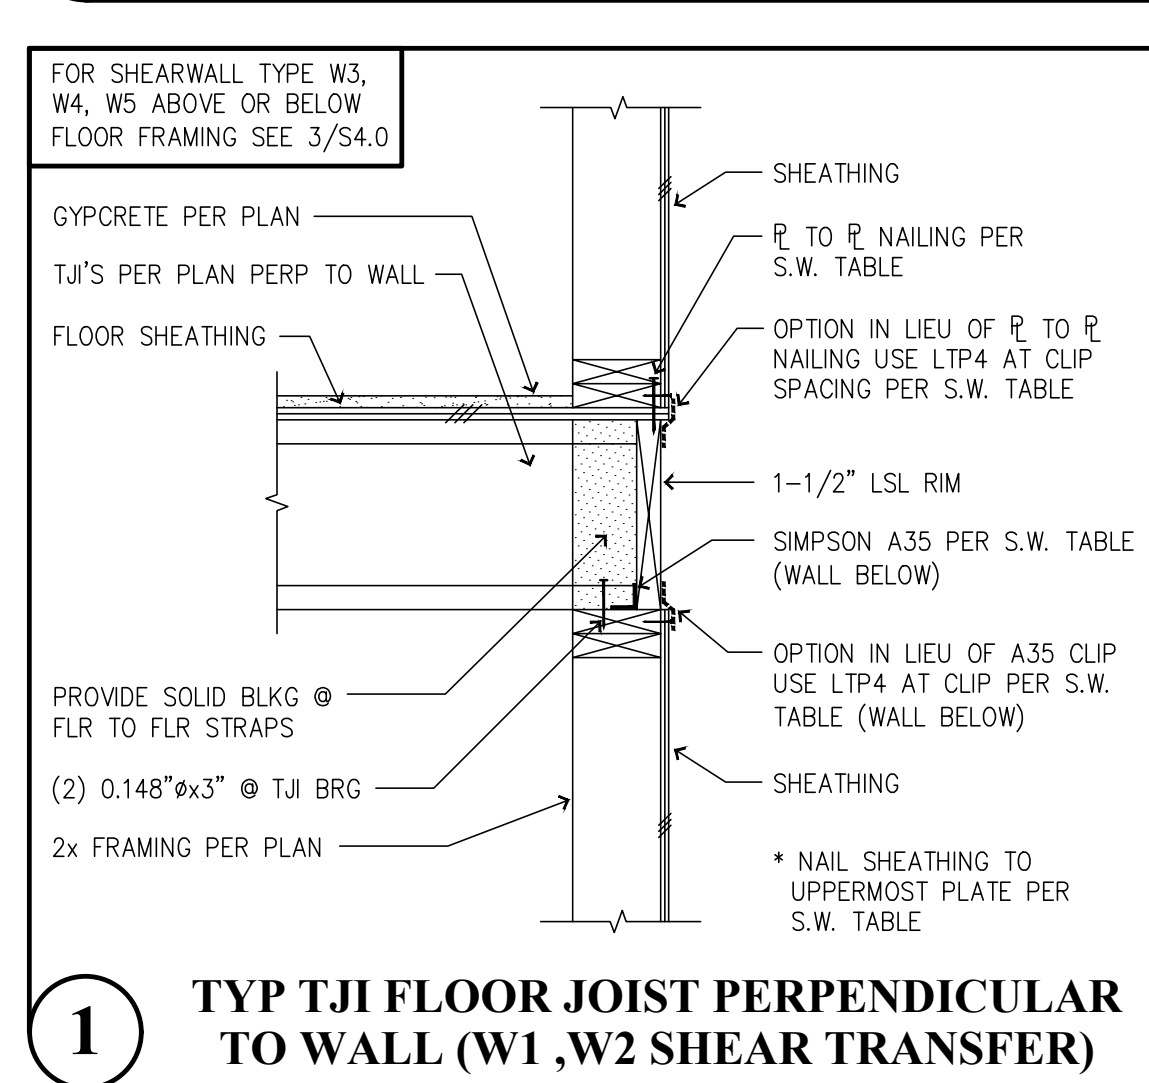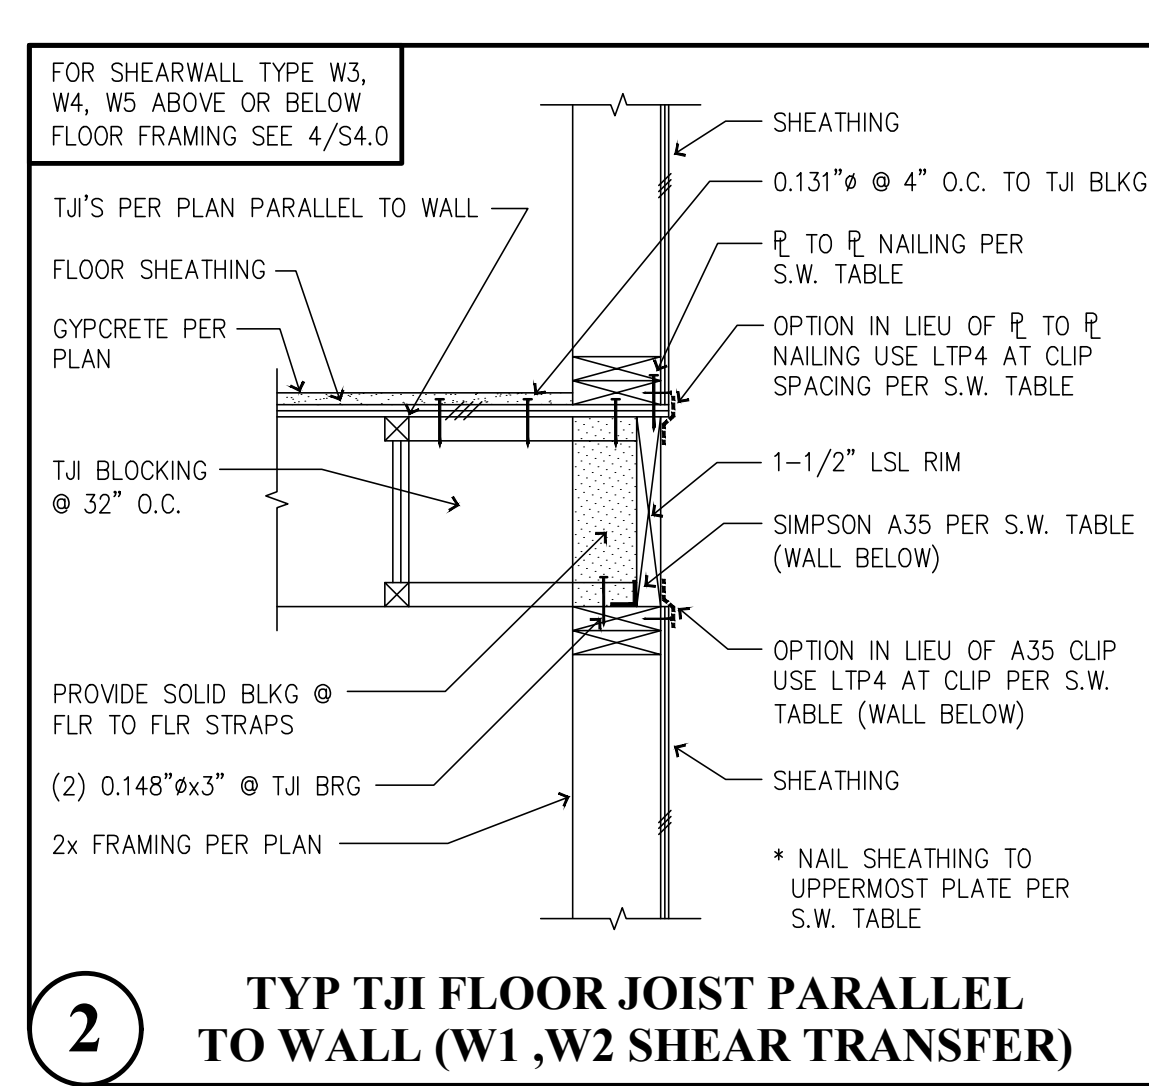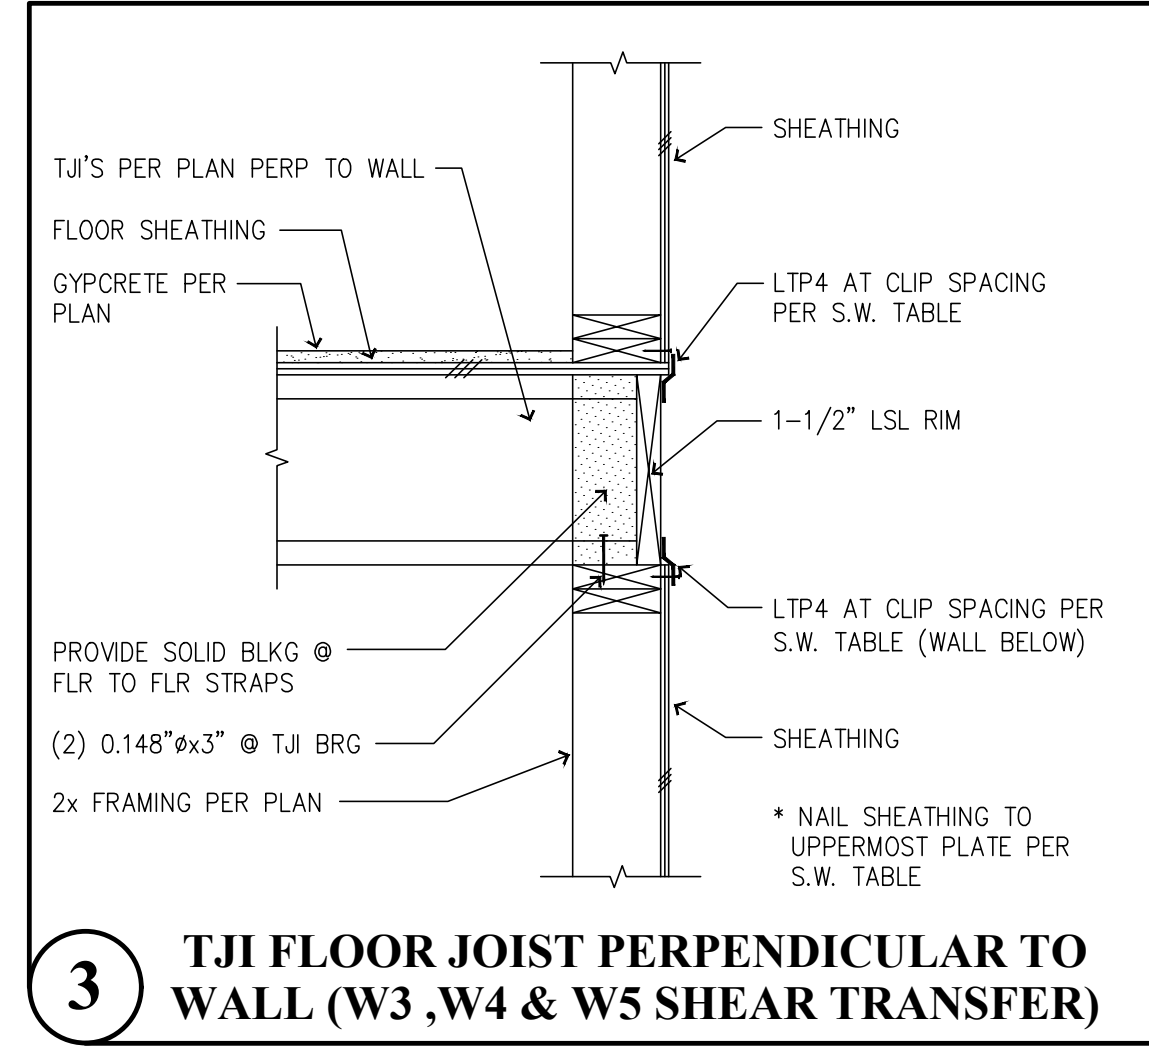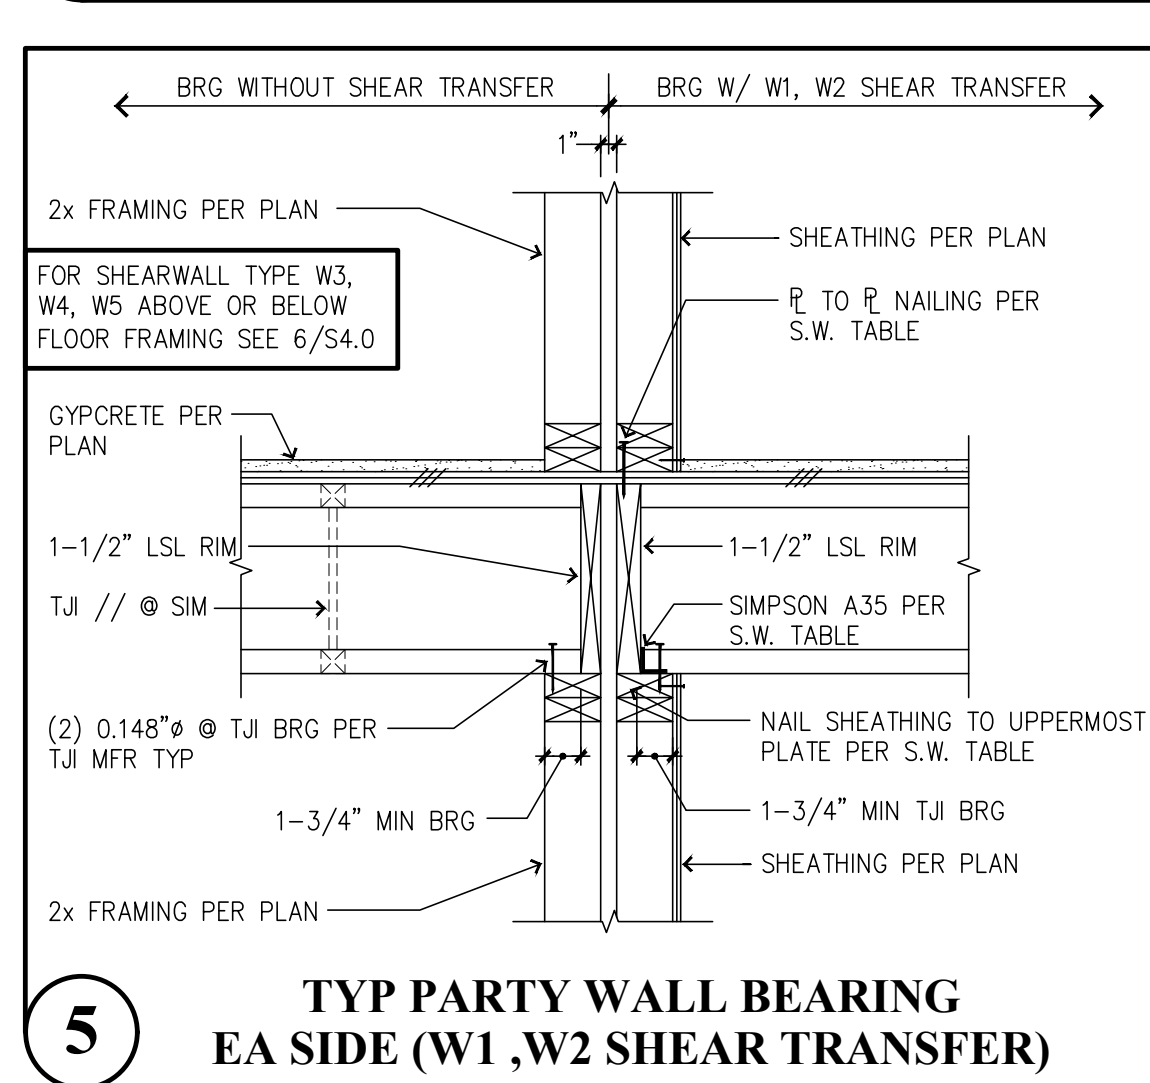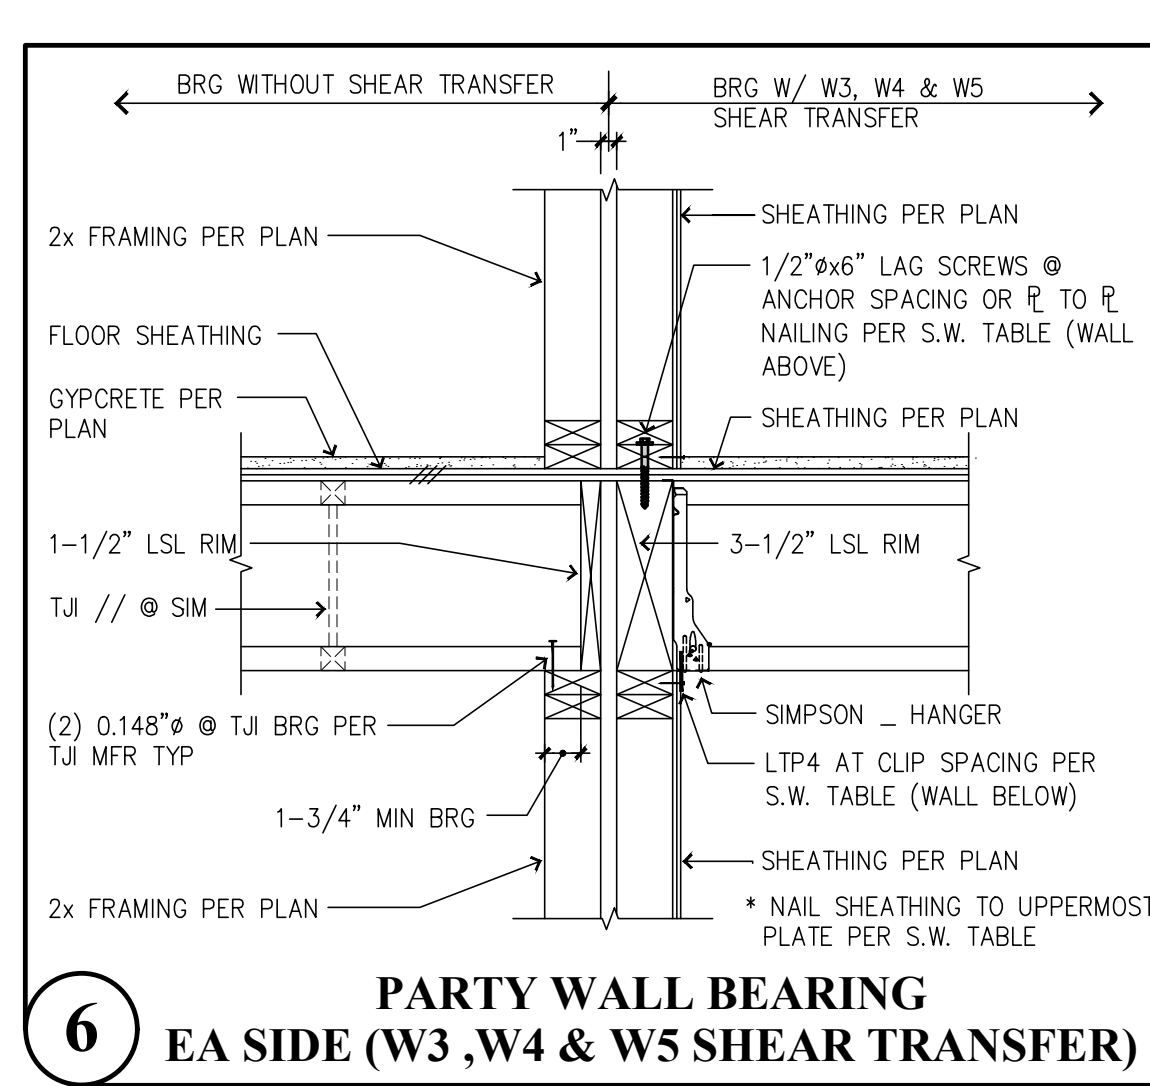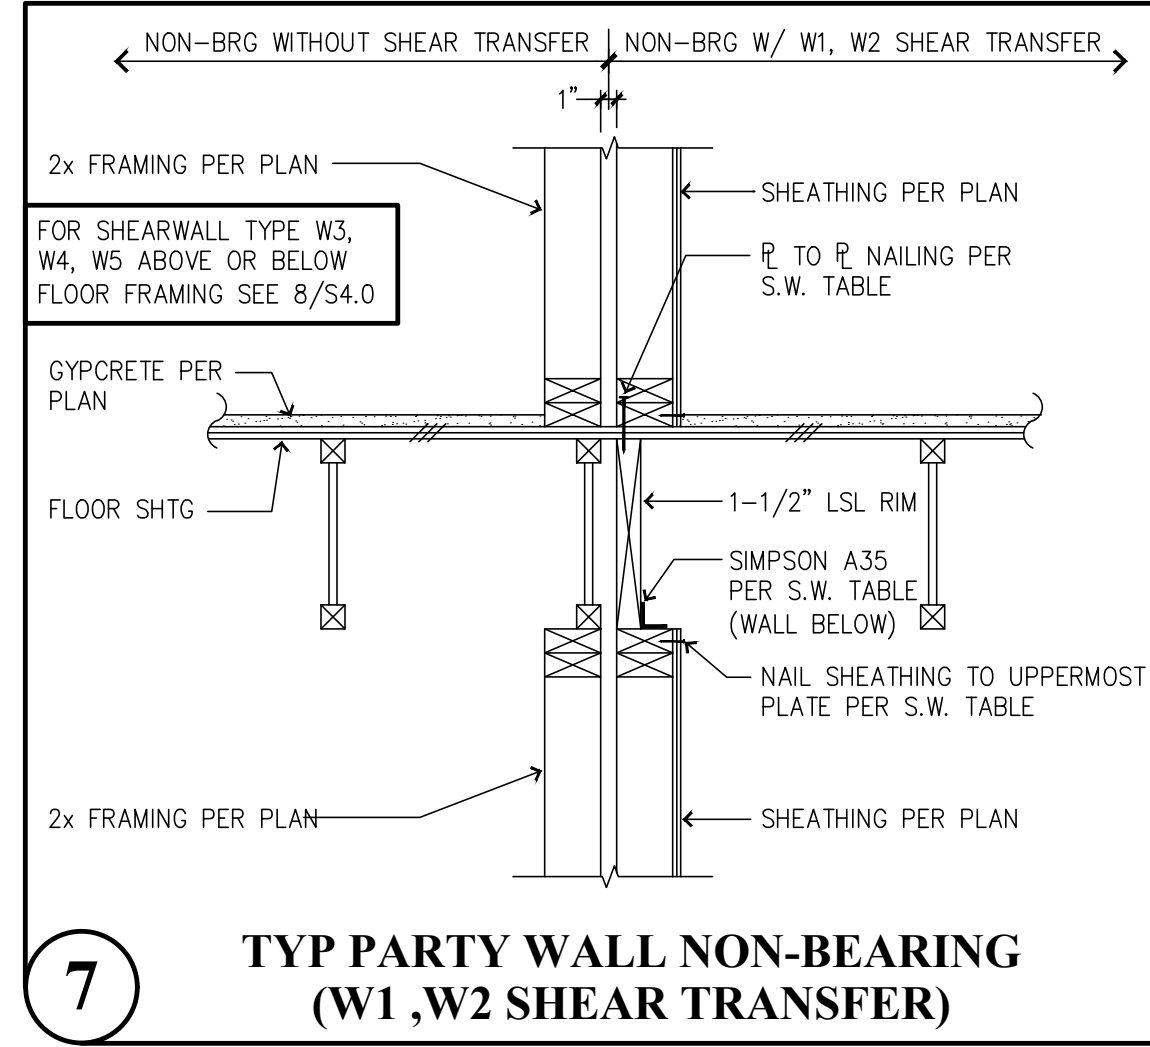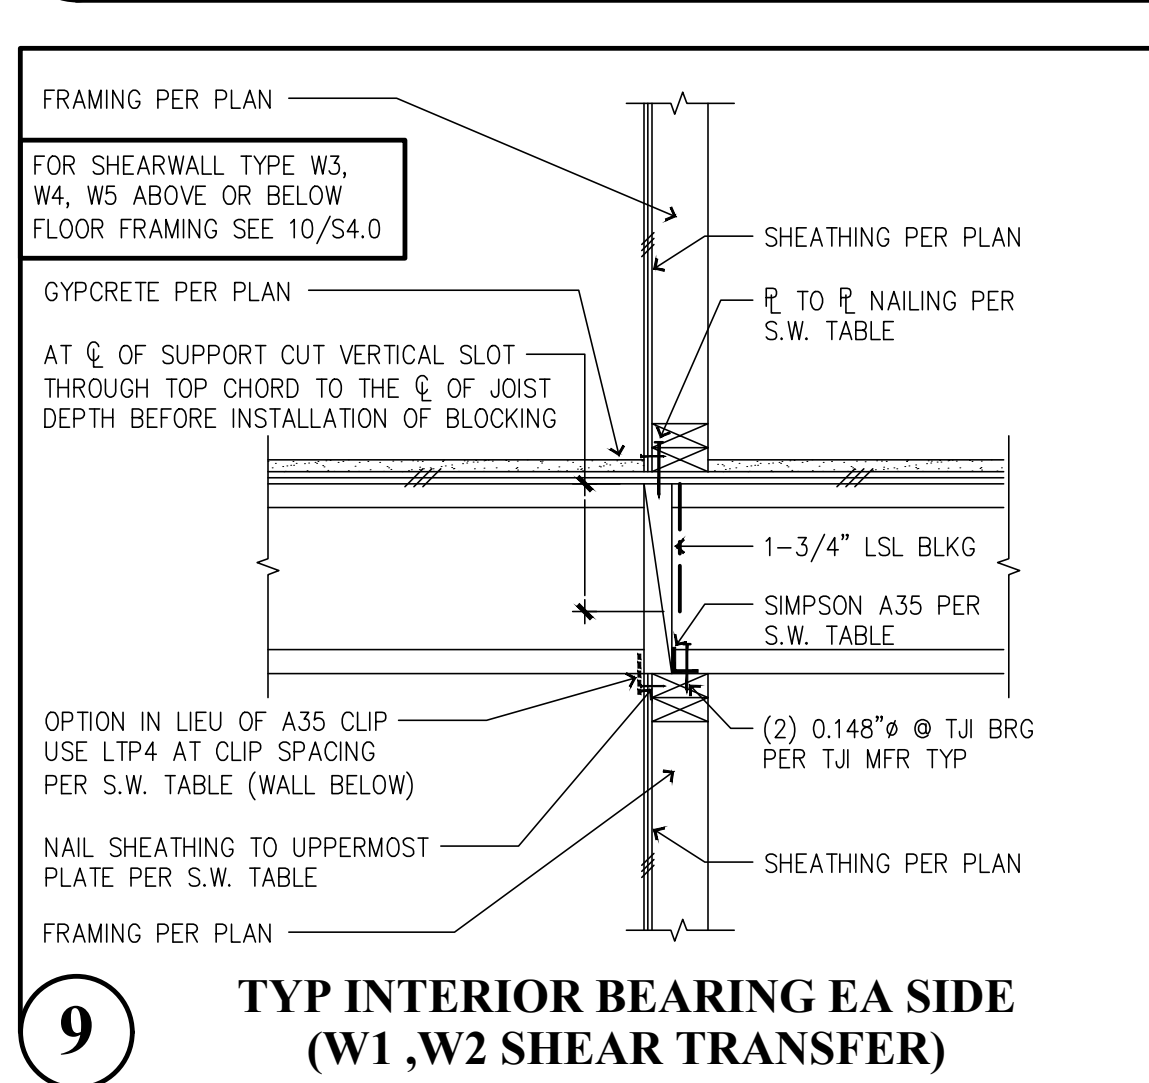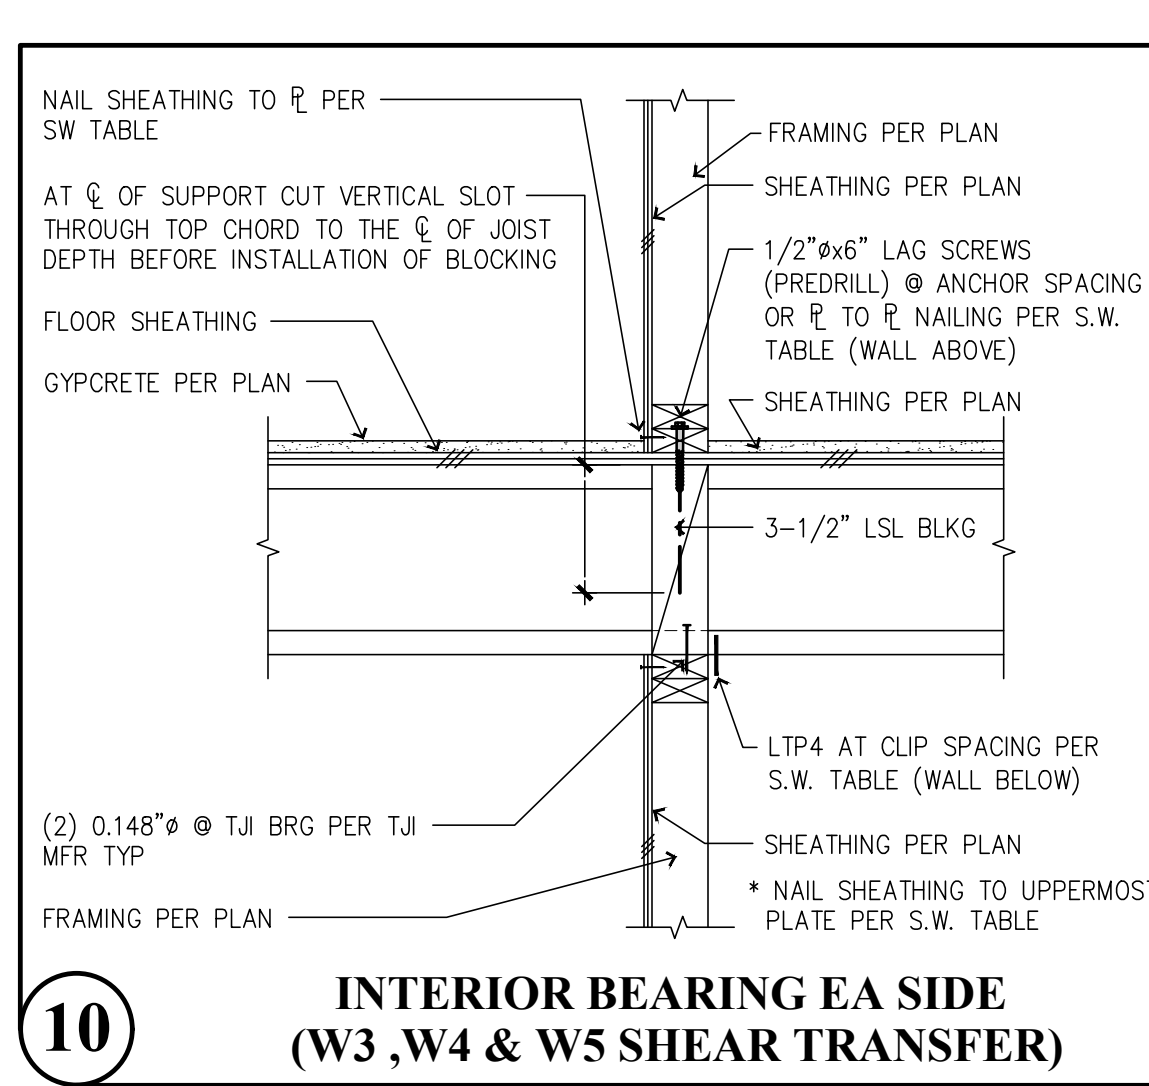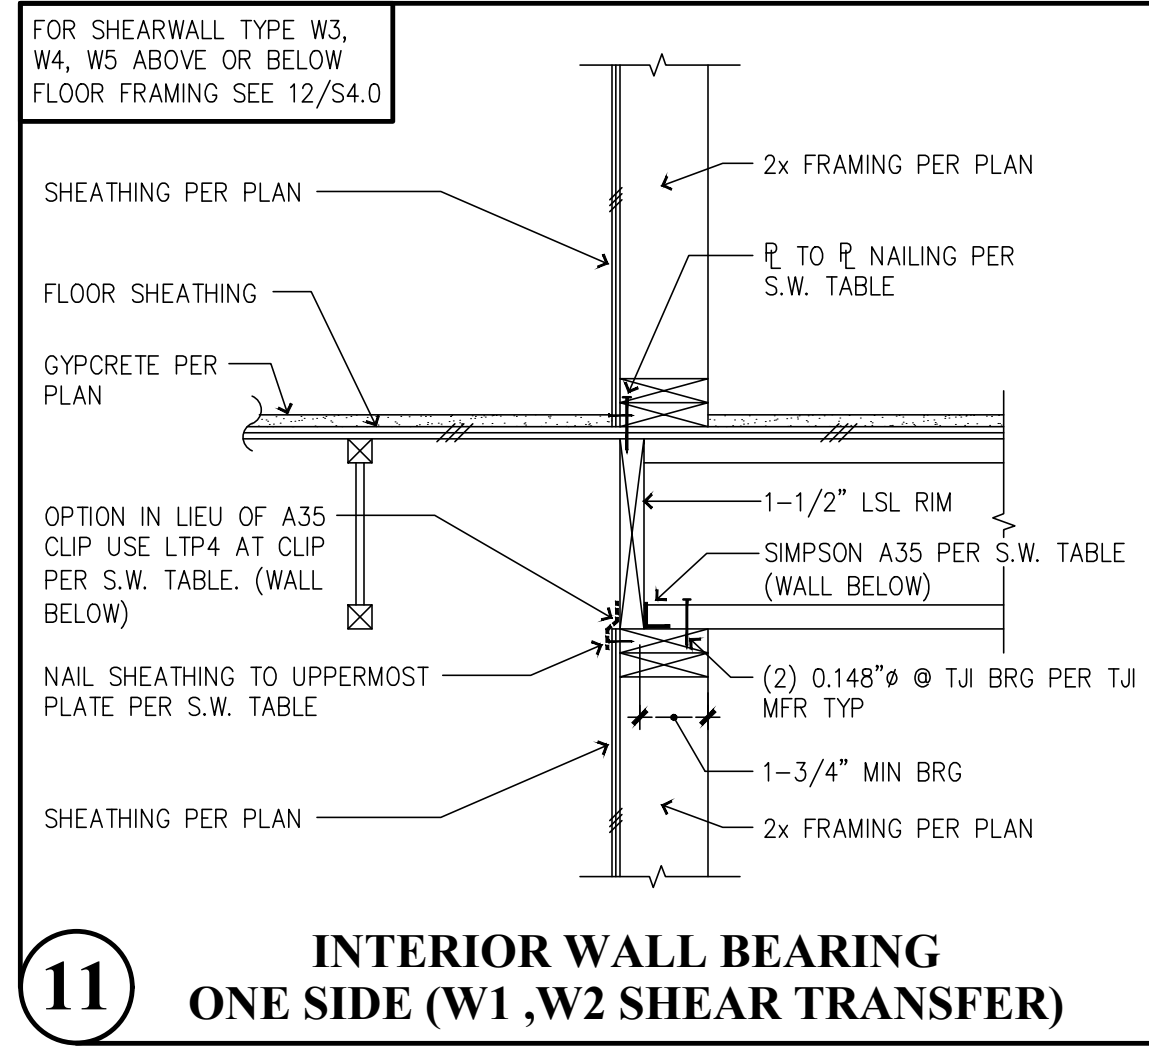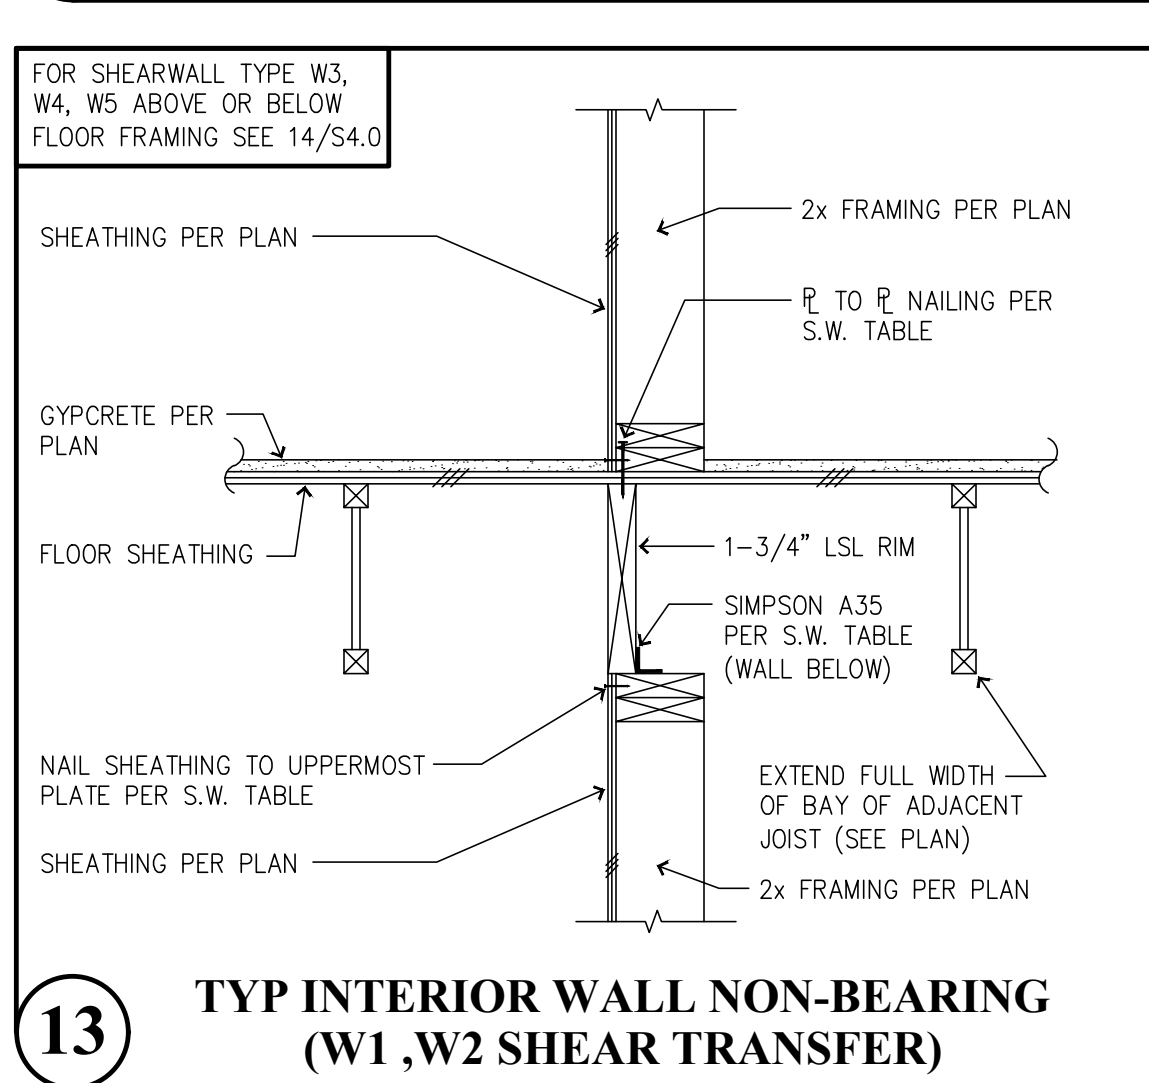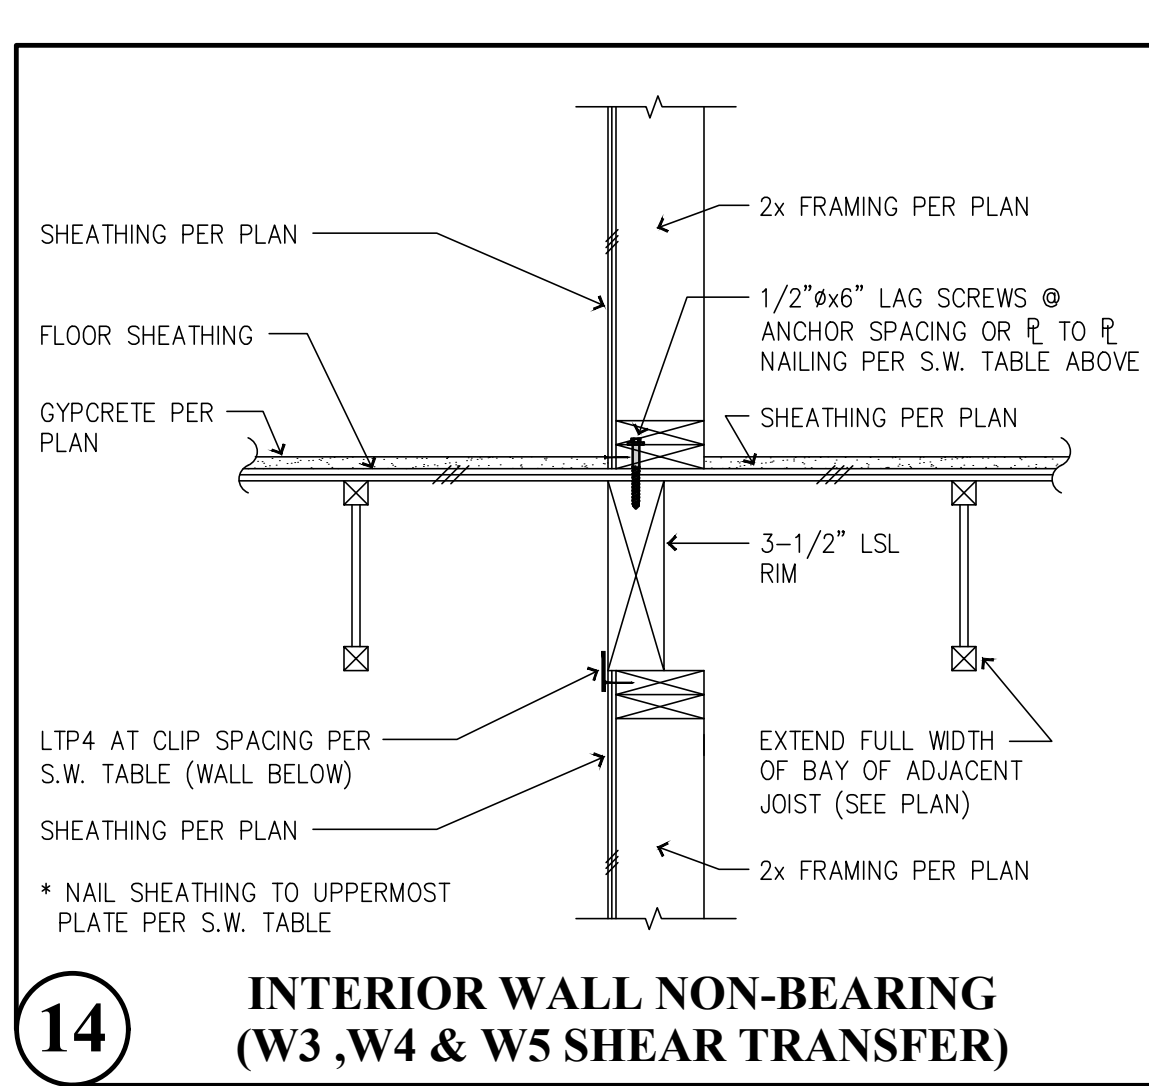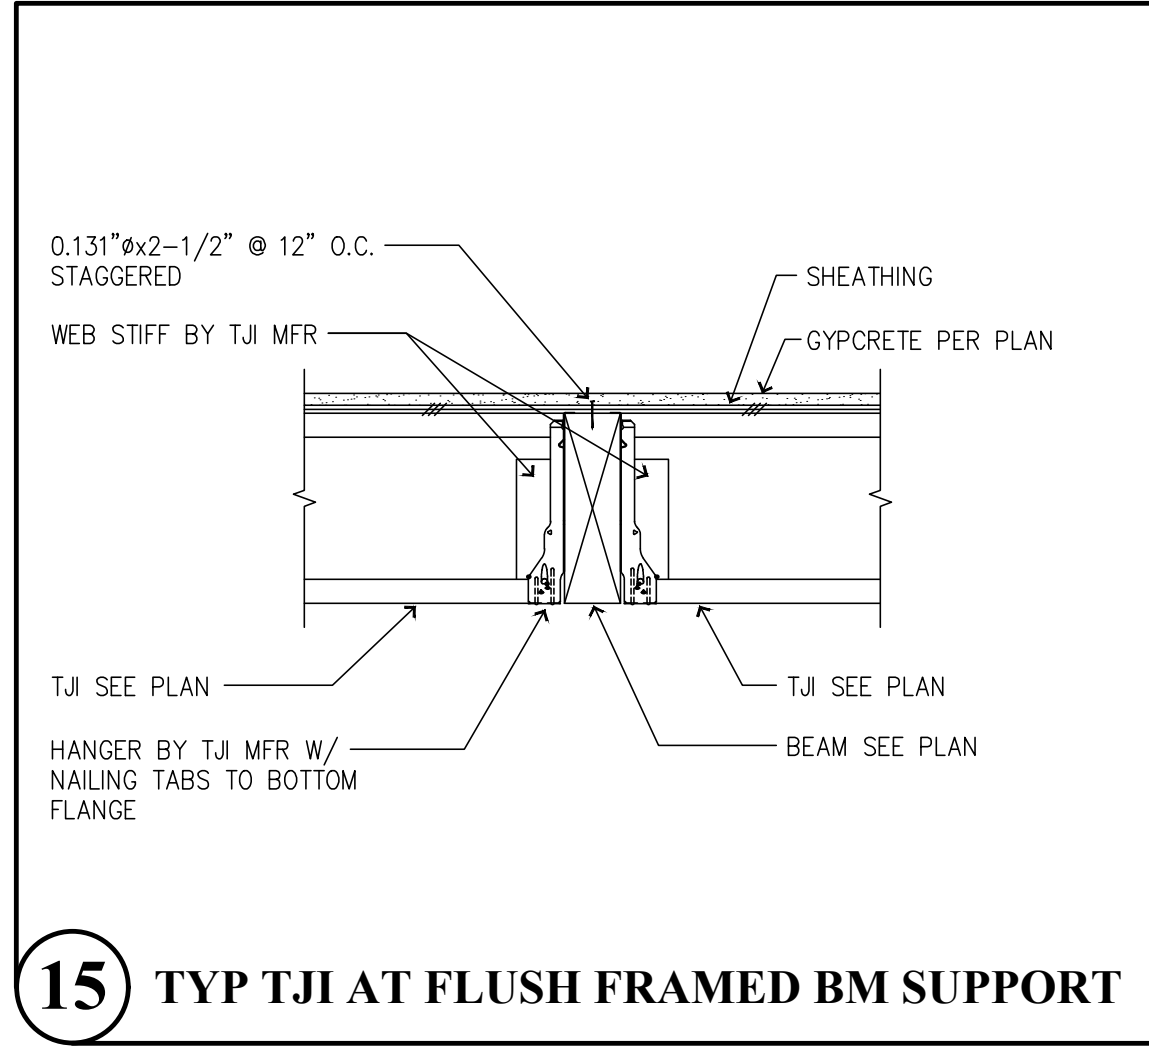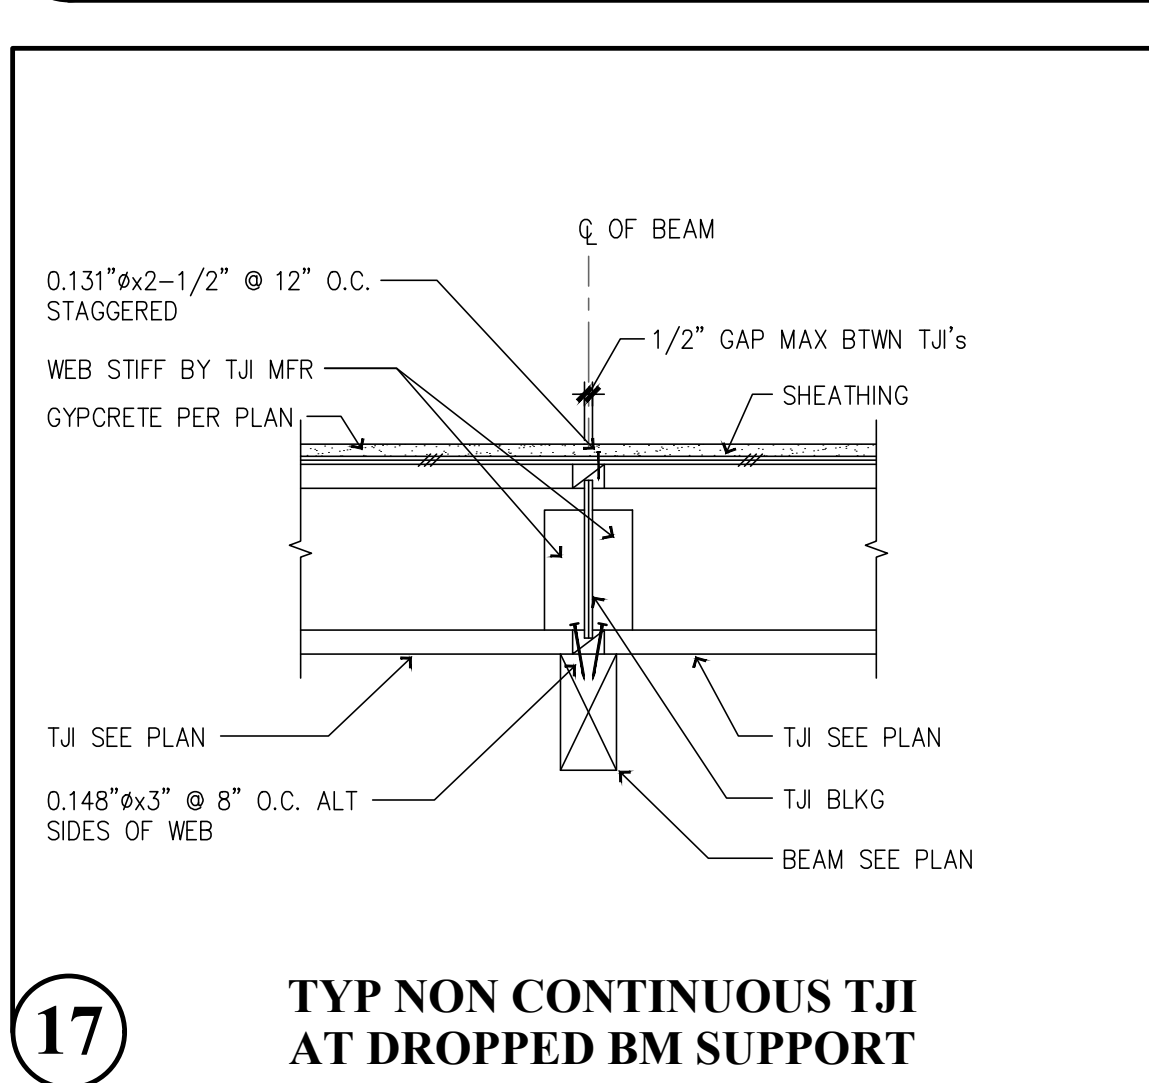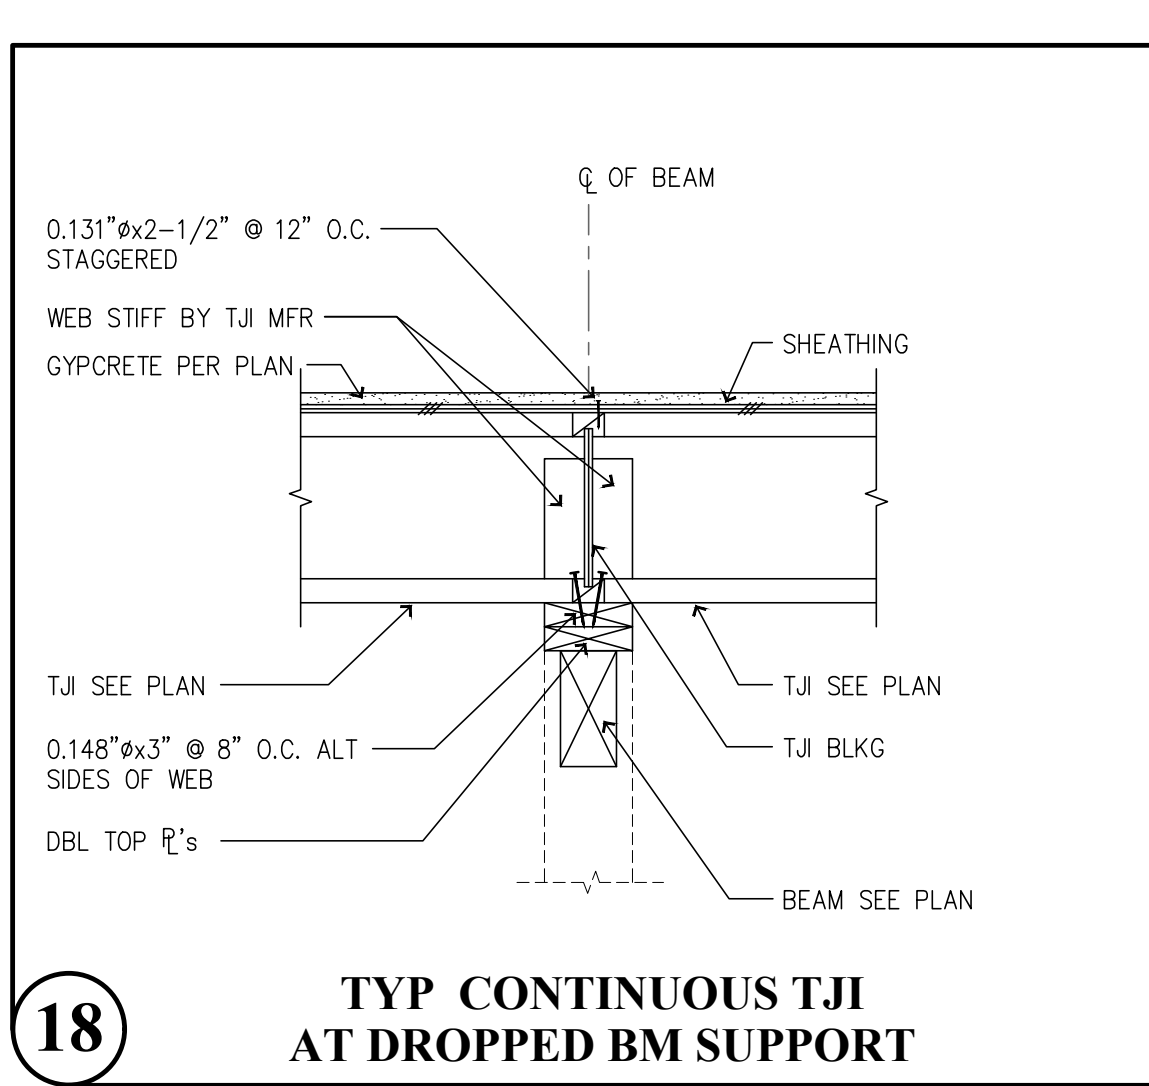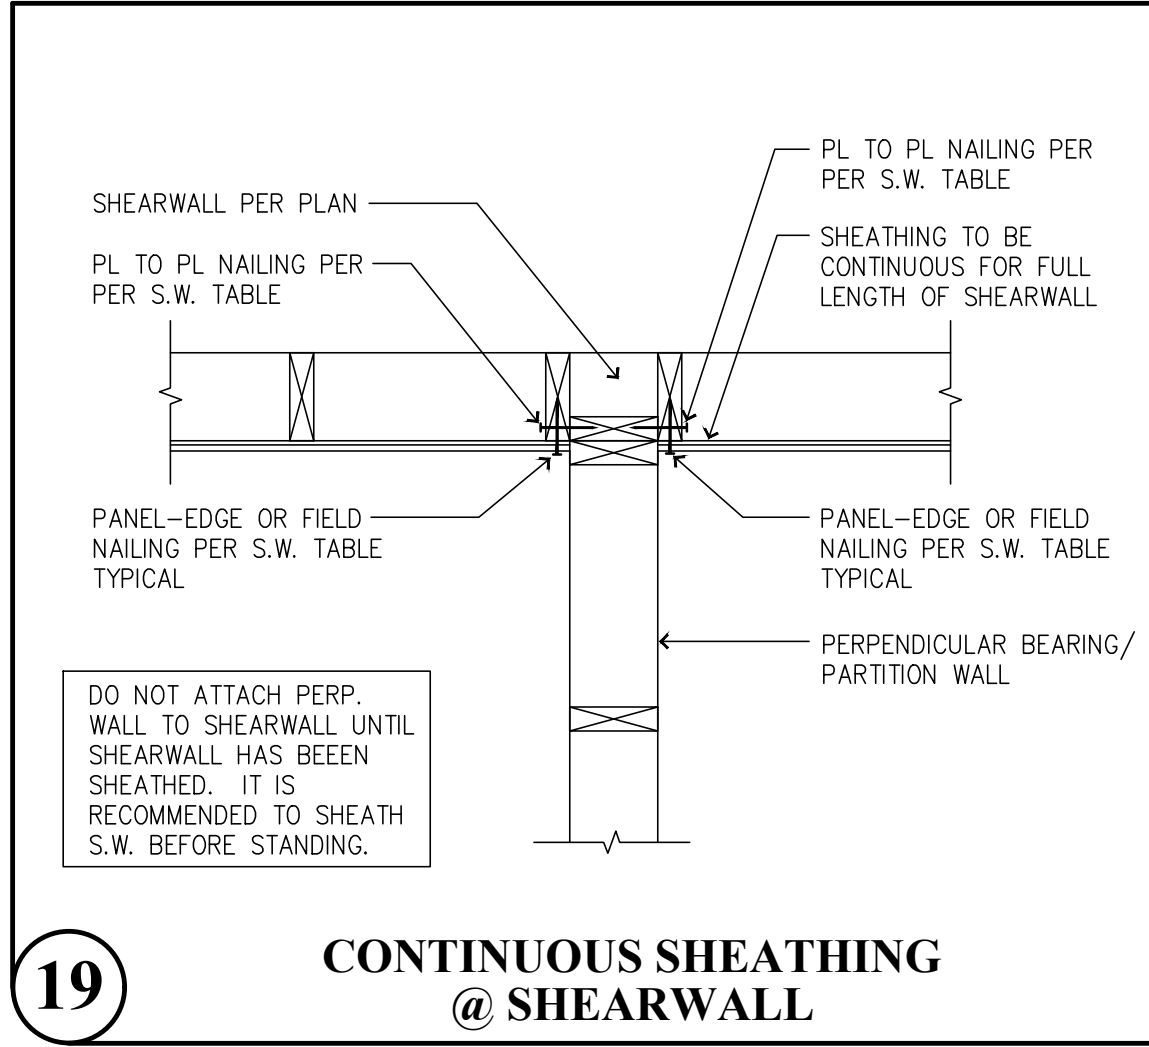

Revisions to this sheet:

Bradley Heights Apartments
202 27th Ave SE
Puyallup, Washington

Solutions 4 Structures
A Structural Engineering Corporation


PROJECT NO. : 23.007
DESIGNED BY : TLC, OGG, MRO
DRAWN BY : RSO
ISSUE DATE : 2-20-24
LATEST REV. OF DWG. SET :

THOMAS L. CHASE, PE
MARTIN R. OMAN, PE, SE
OLEG G. KONDRATYUK, PE

Puyallup, Washington 98374
Ph 253-314-9822
www.solutions4structures.com

SUBMITTAL SET ONLY NOT FOR CONSTRUCTION
THESE DRAWINGS ARE SUBJECT TO REVISIONS
PENDING LOCAL JURISDICTIONAL REVIEW.

S4.0

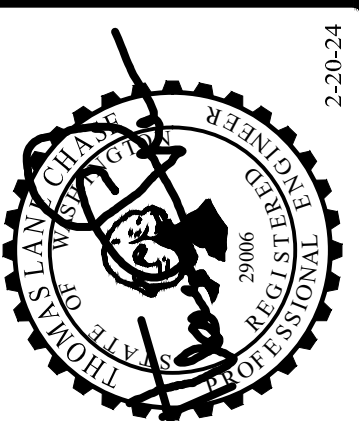

THOMAS L. CHASE, PE
MARTIN R. OMAN, PE, SE
OLEG G. KONDRATYUK, PE

Revisions to this sheet:

Bradley Heights Apartments
202 27th Ave SE
Puyallup, Washington









Puyallup, Washington 98374
Ph. 253-314-9822
www.solutions4structures.com

Solutions 4 Structures
A Structural Engineering Corporation





















PROJECT NO. : 23.007
DESIGNED BY : TLC, OGG, MRO
DRAWN BY : RSO
ISSUE DATE : 2-20-24
LATEST REV. OF DWG. SET :

SUBMITTAL SET ONLY NOT FOR CONSTRUCTION
THESE DRAWINGS ARE SUBJECT TO REVISIONS
PENDING LOCAL JURISDICTIONAL REVIEW.

S4.1

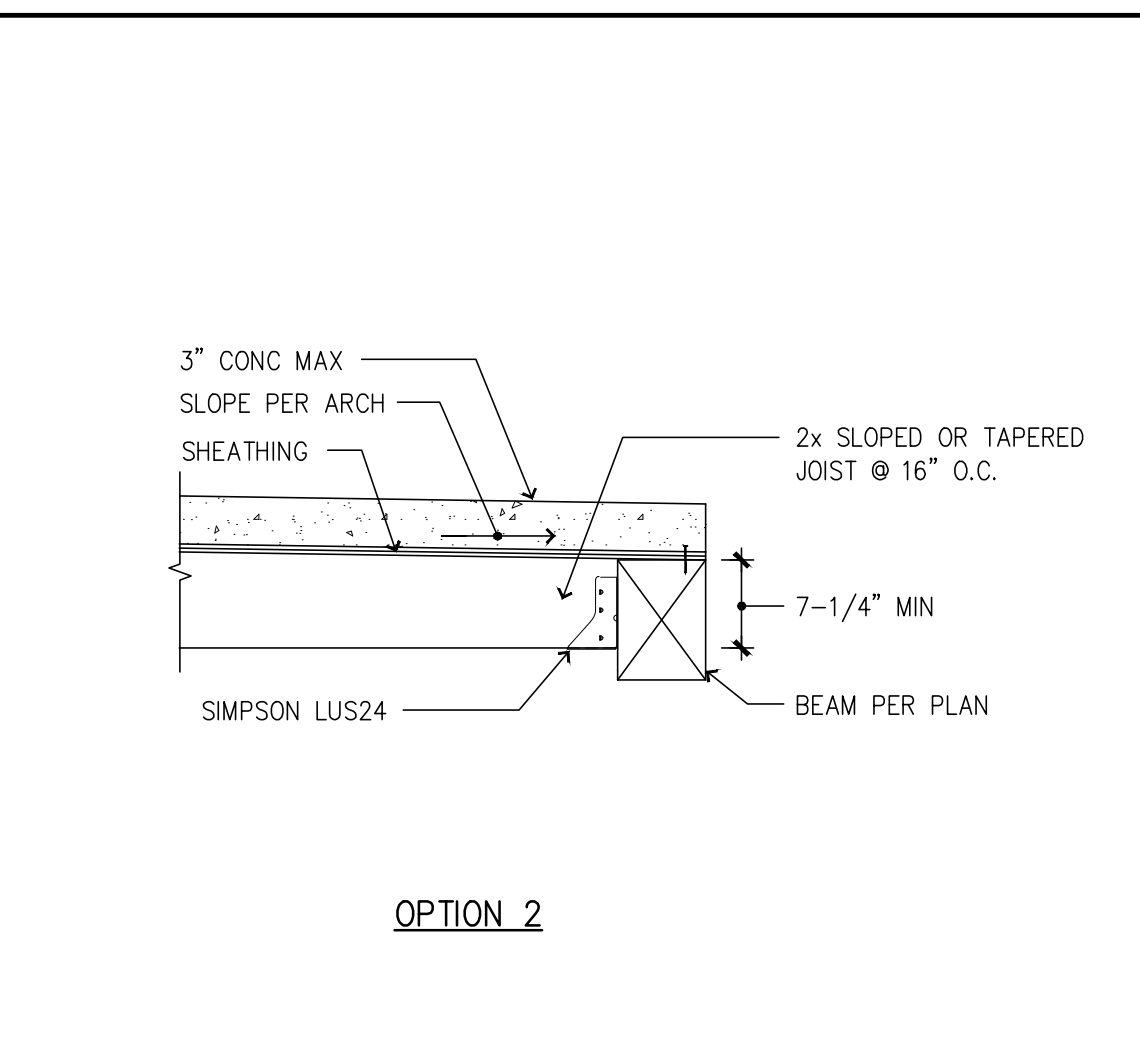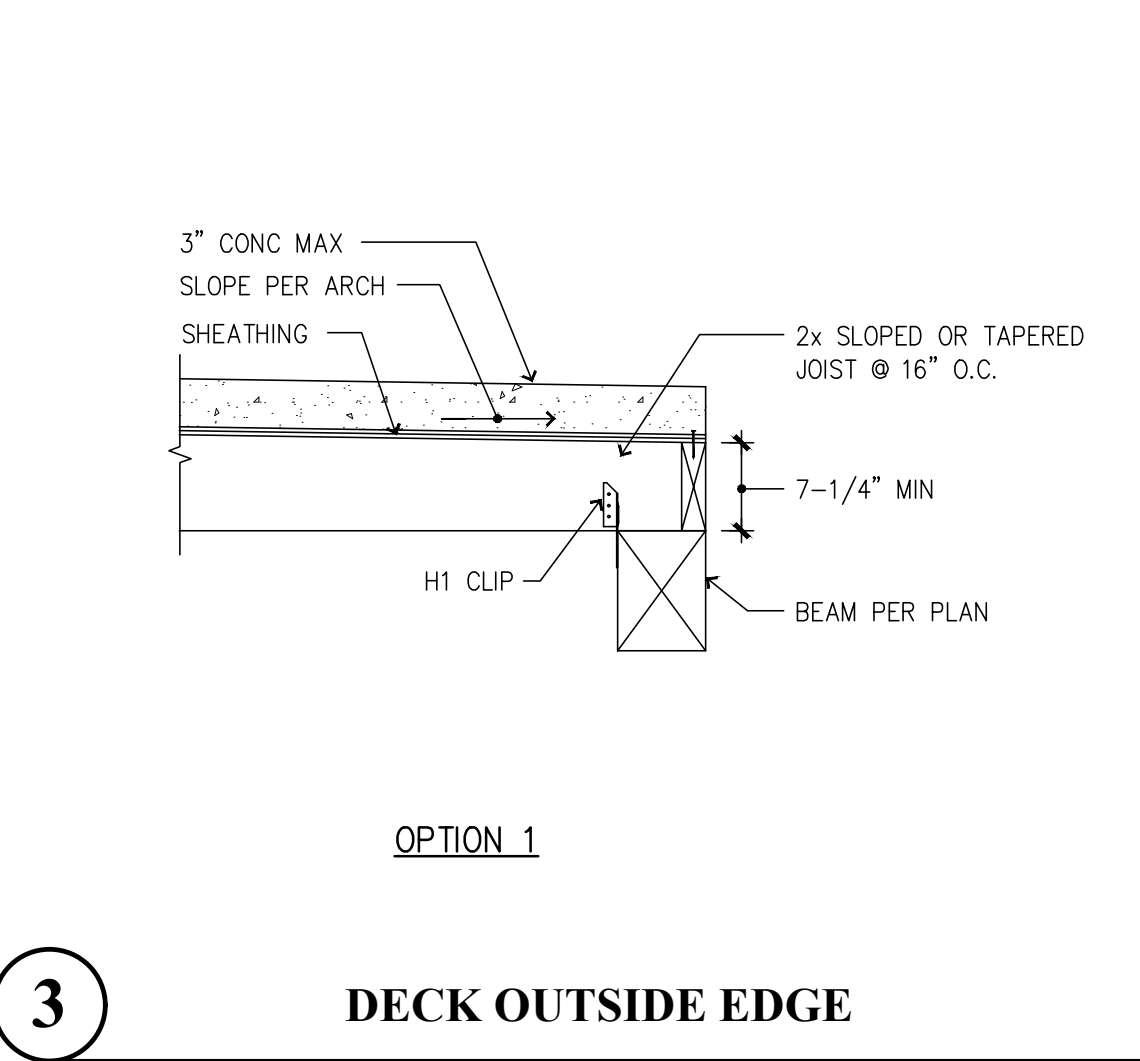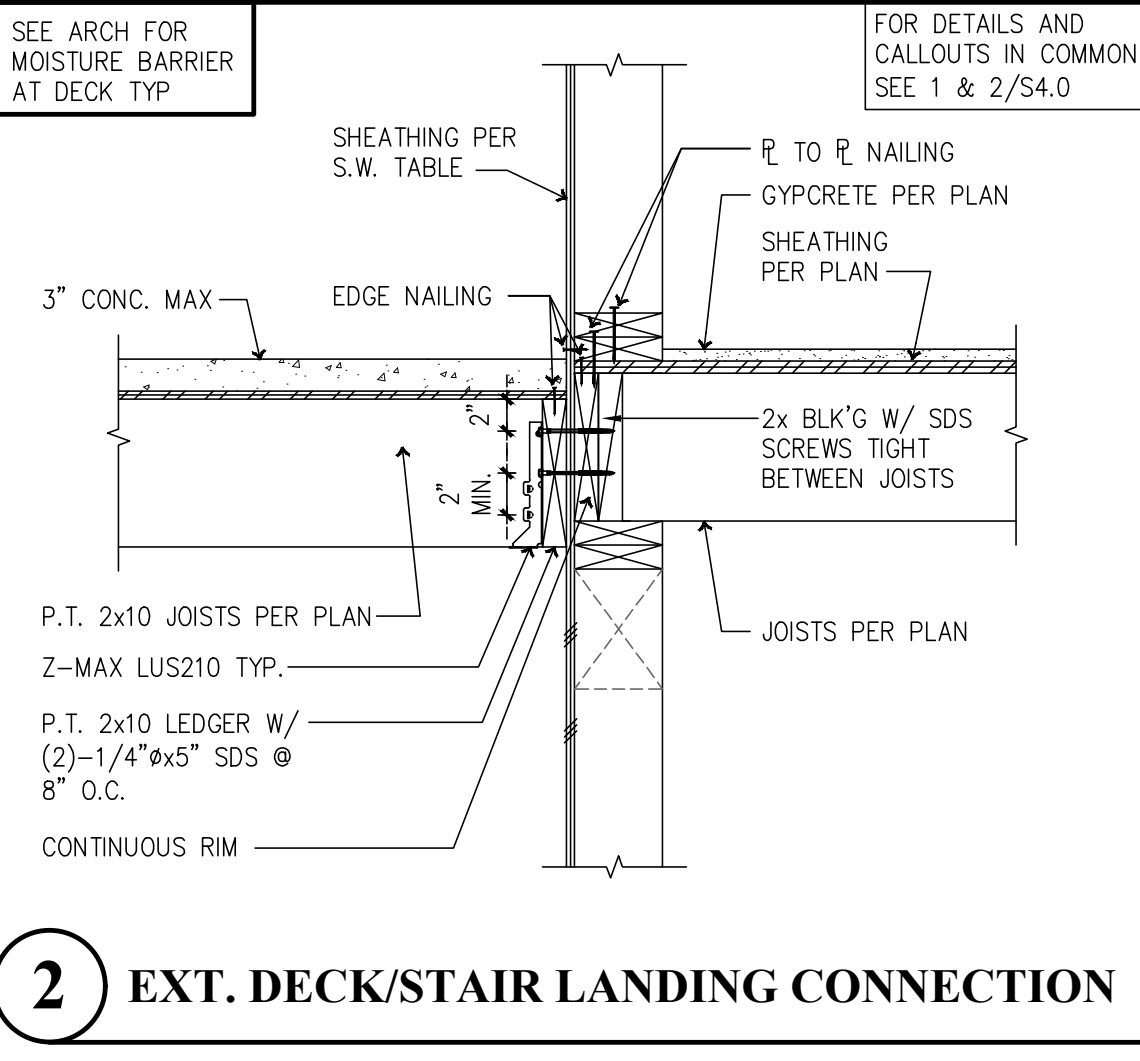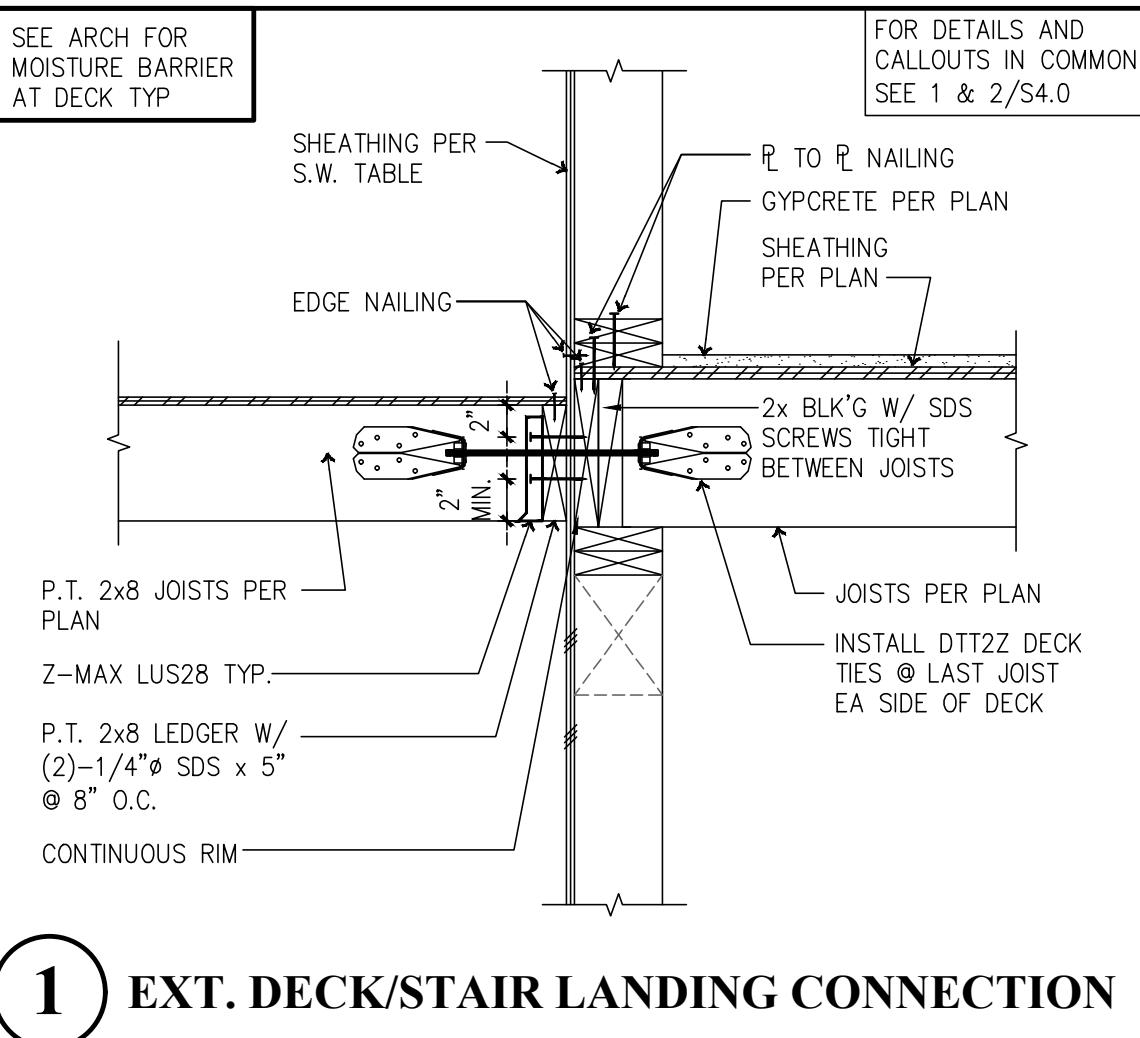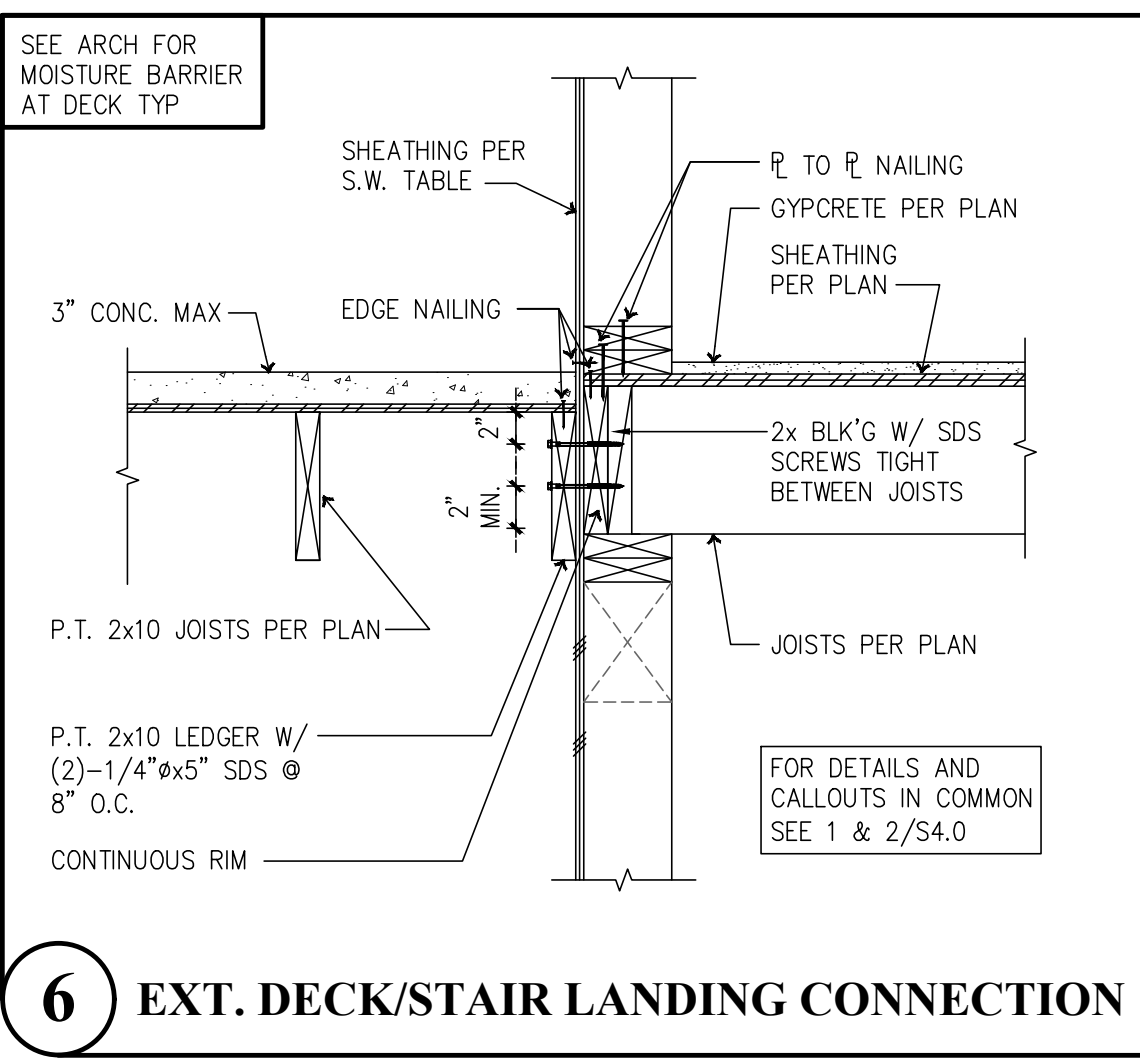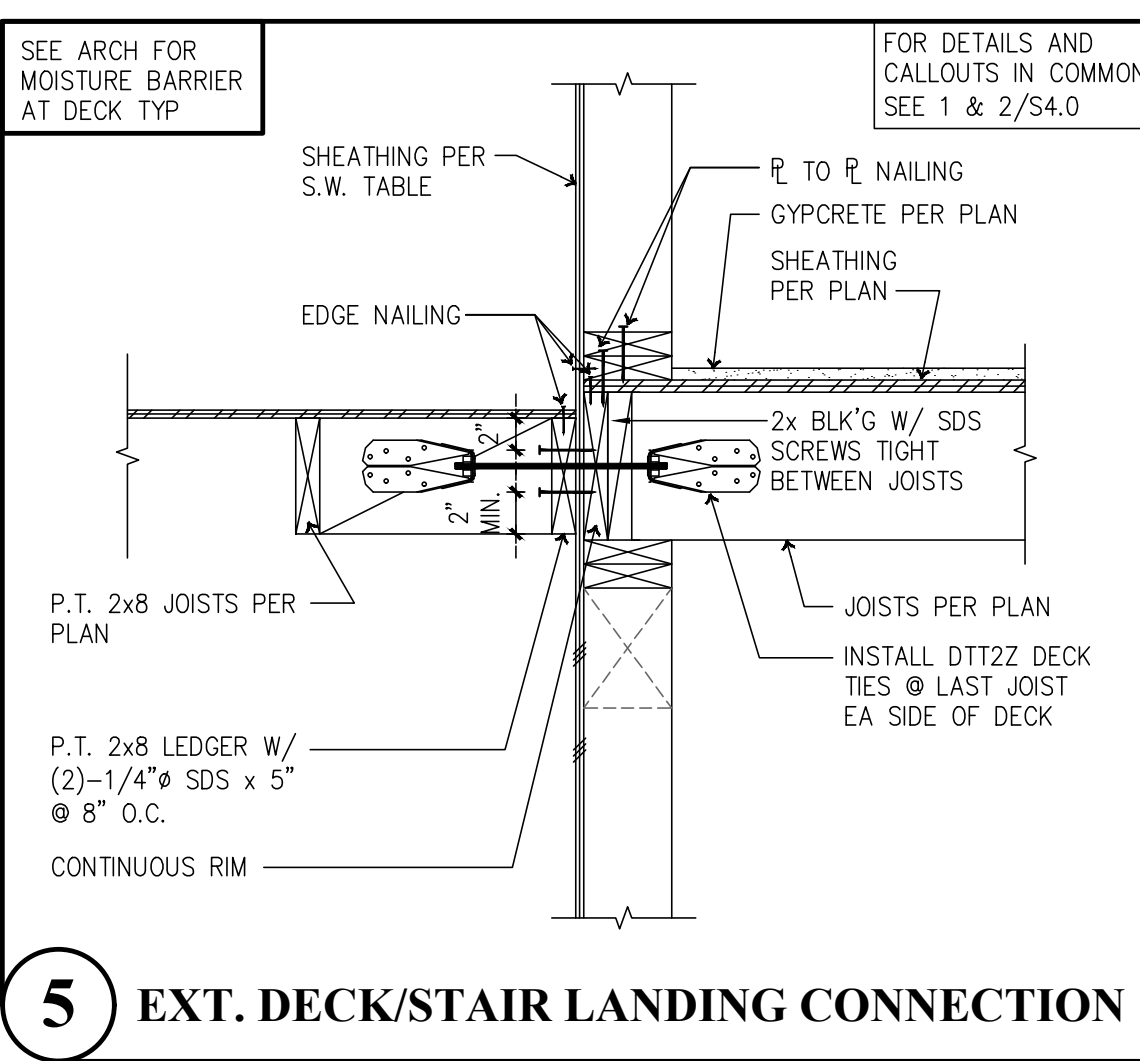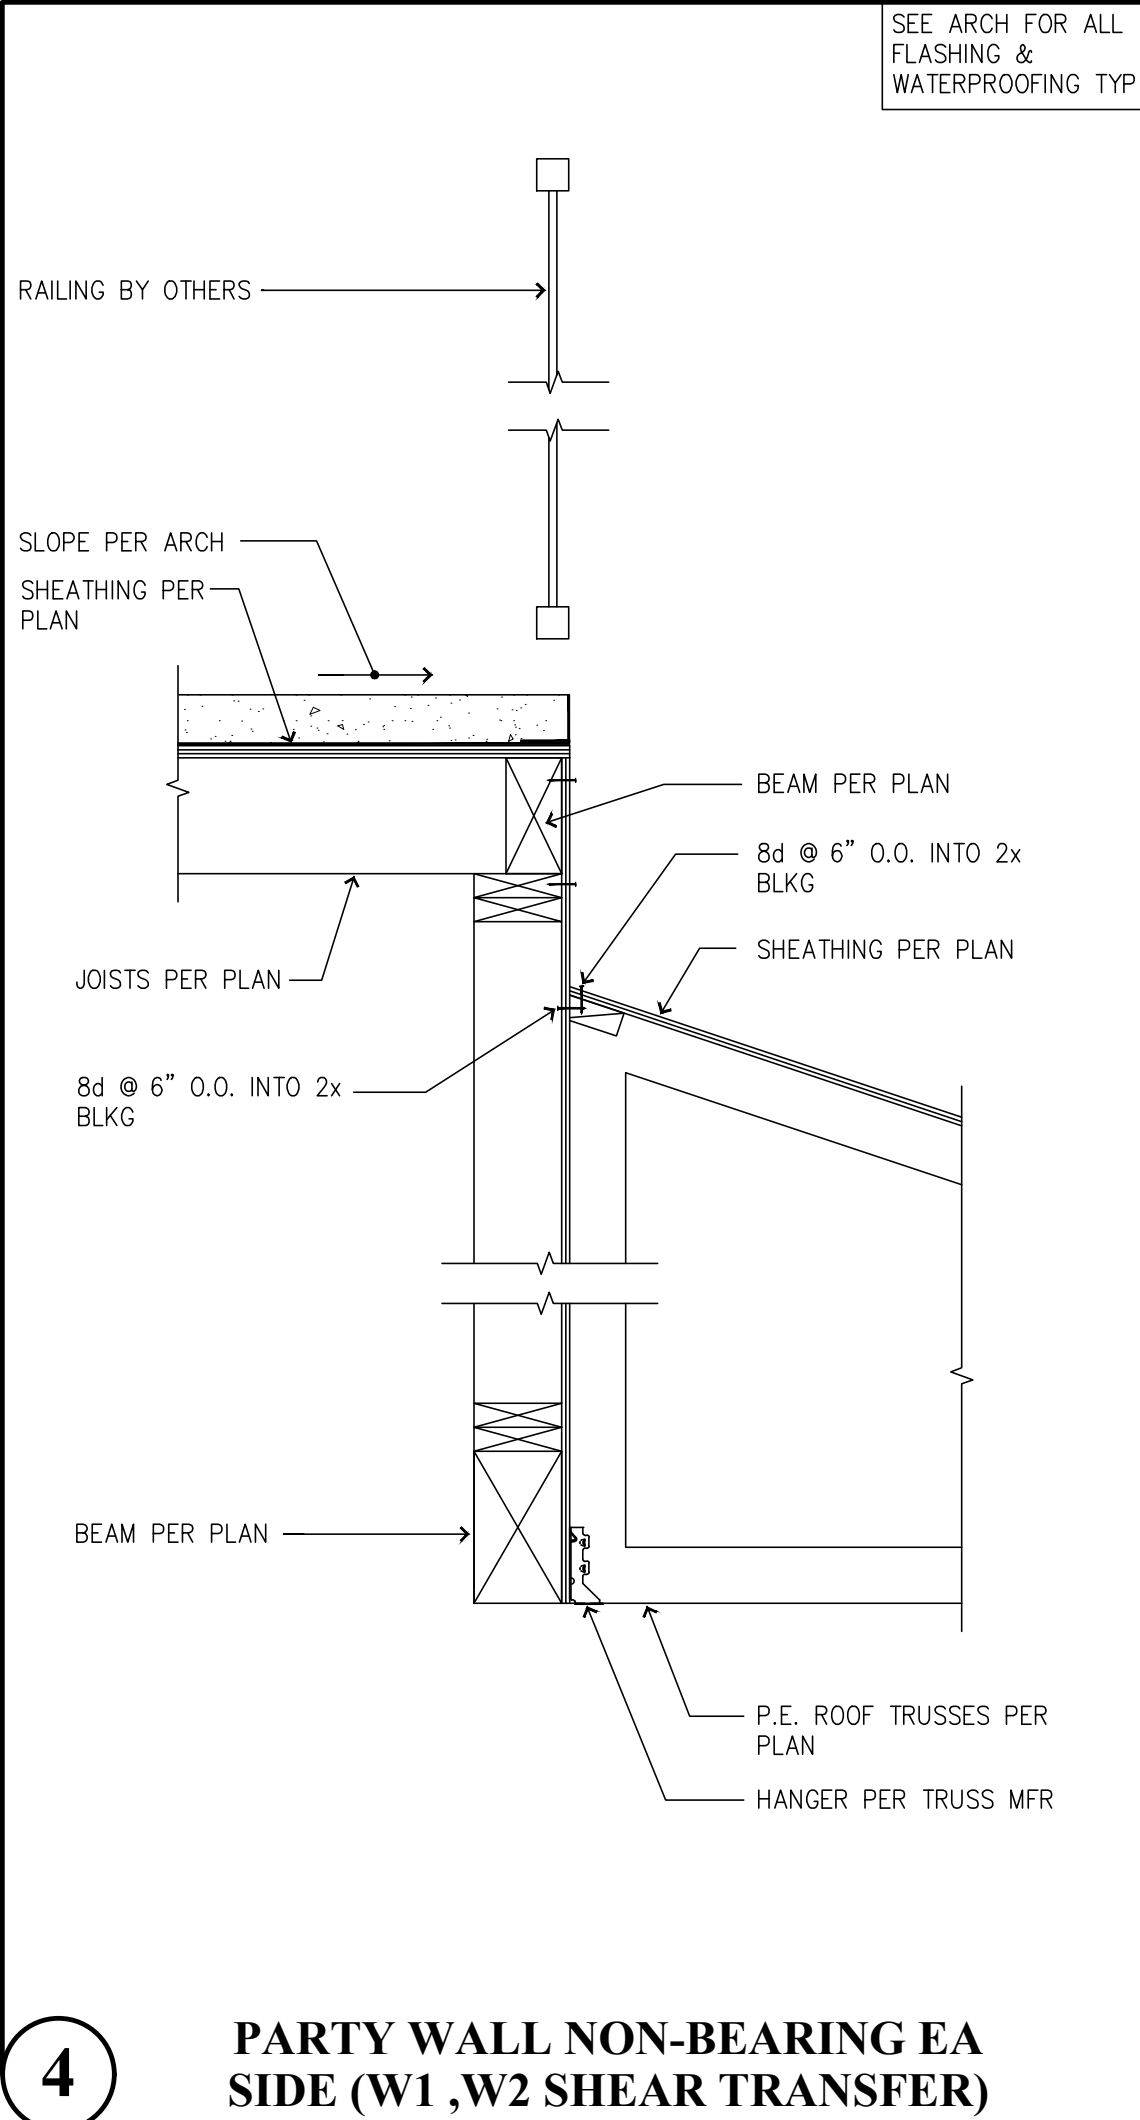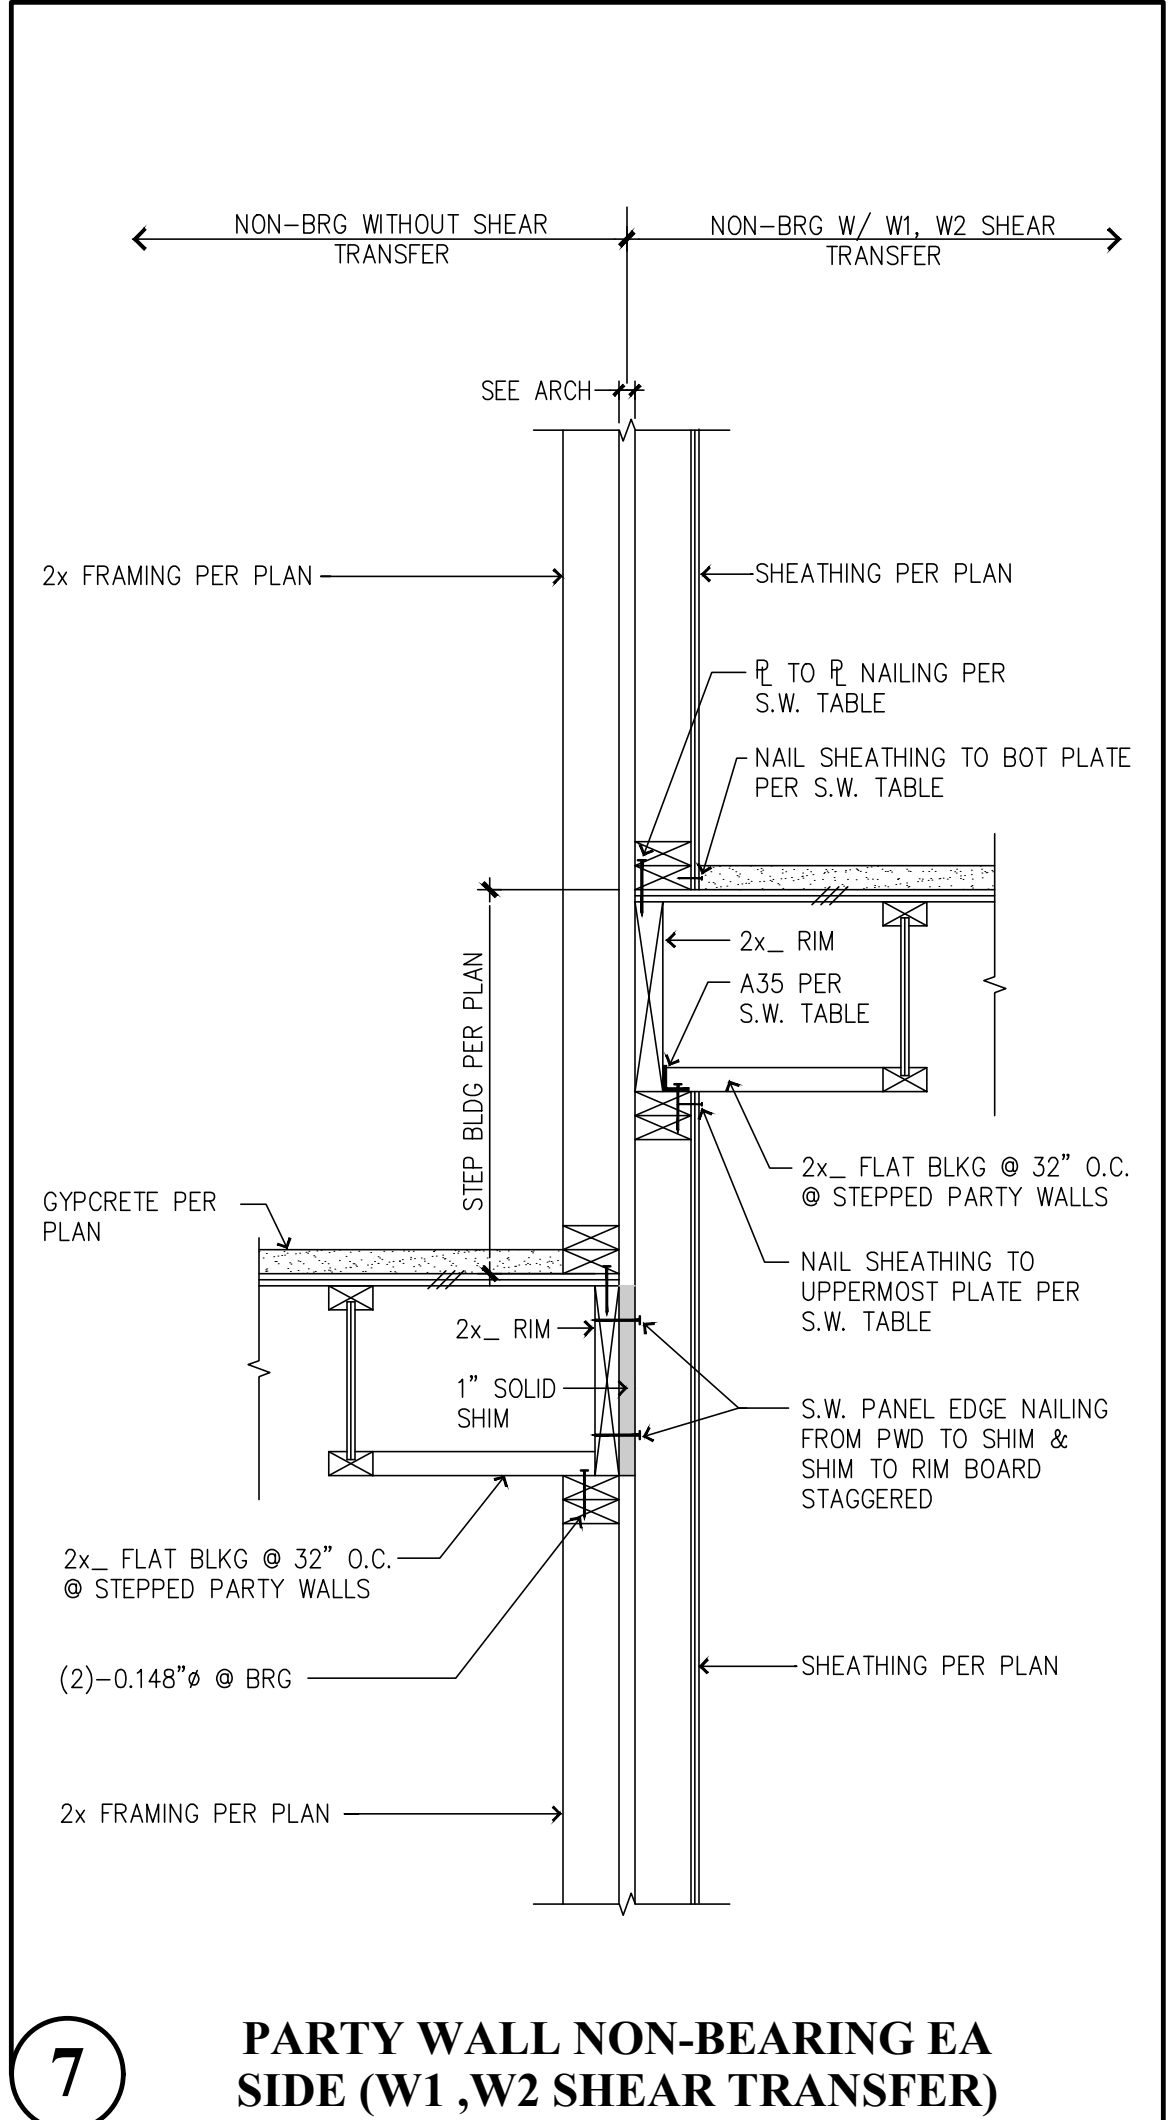

CAD FILE: F:\Projects\2023 Projects\23.007 Bradley Heights\Drawings\S5.0.dwg
 PLOT DATE/TIME: 2/15/2024 - 9:50am THANK YOU FOR USING SOLUTIONS 4 STRUCTURES

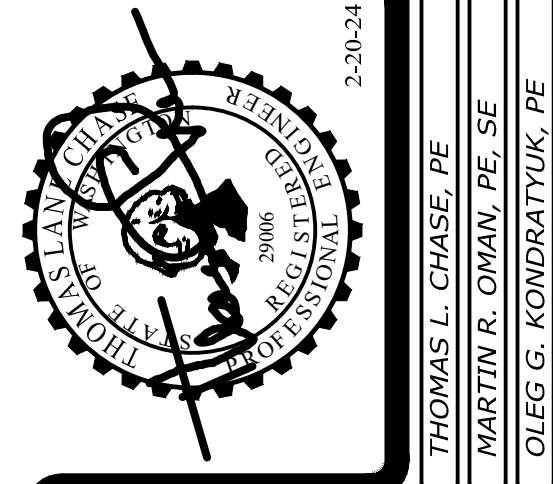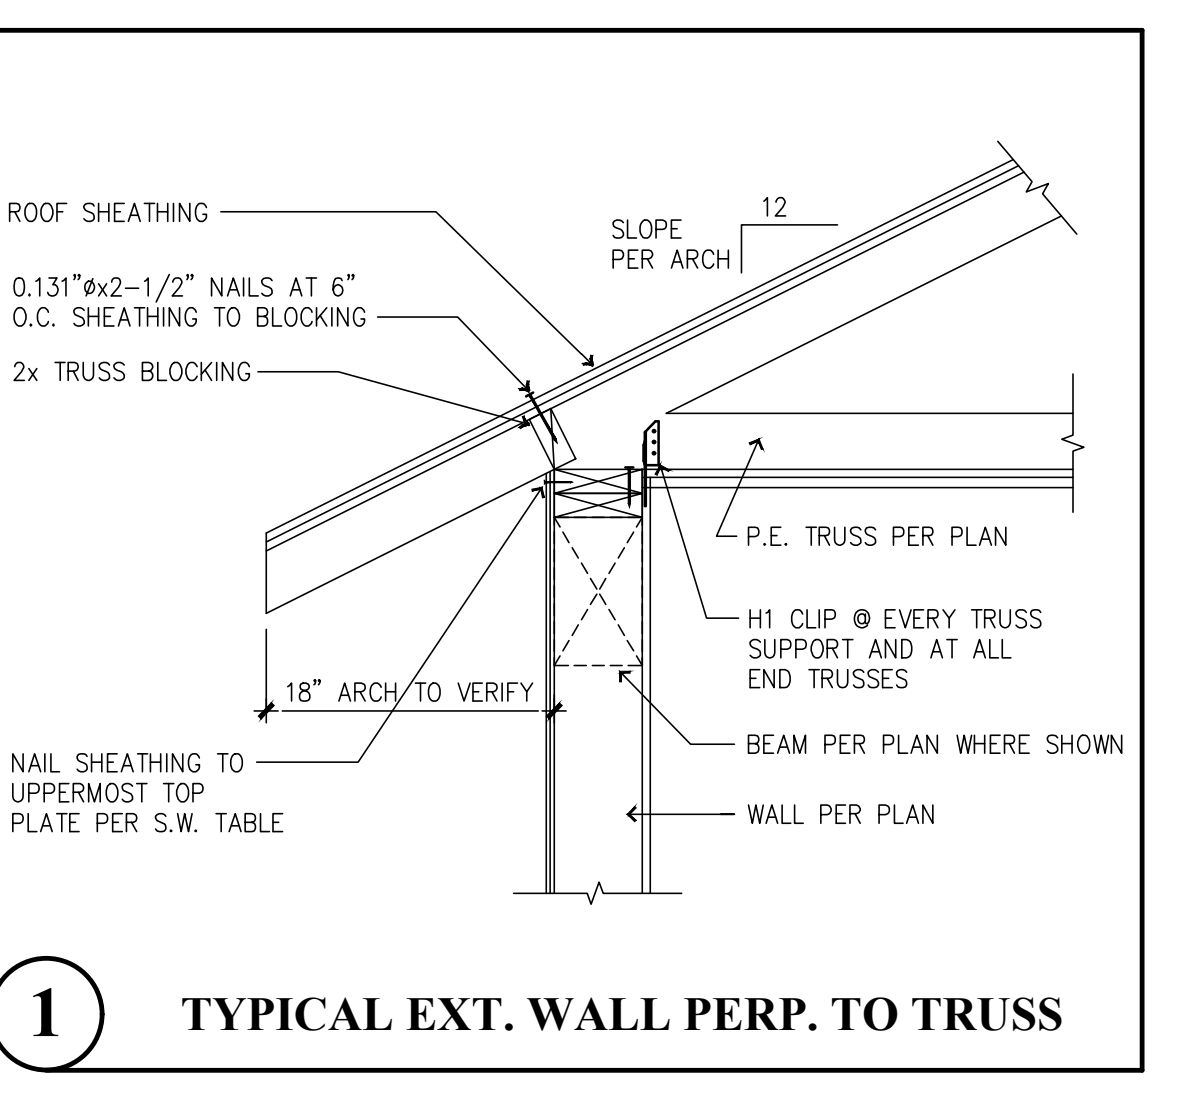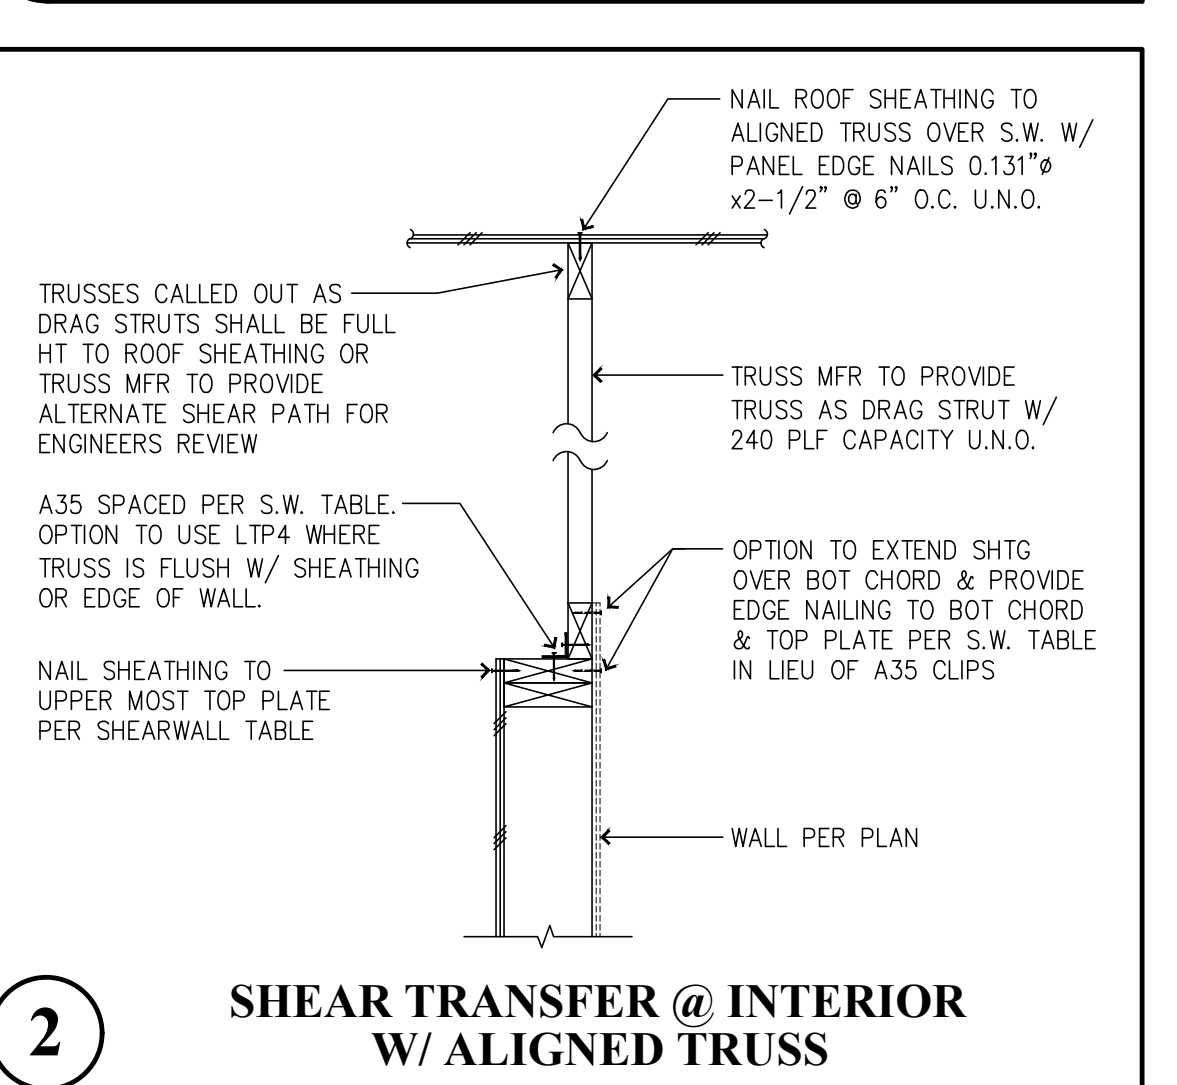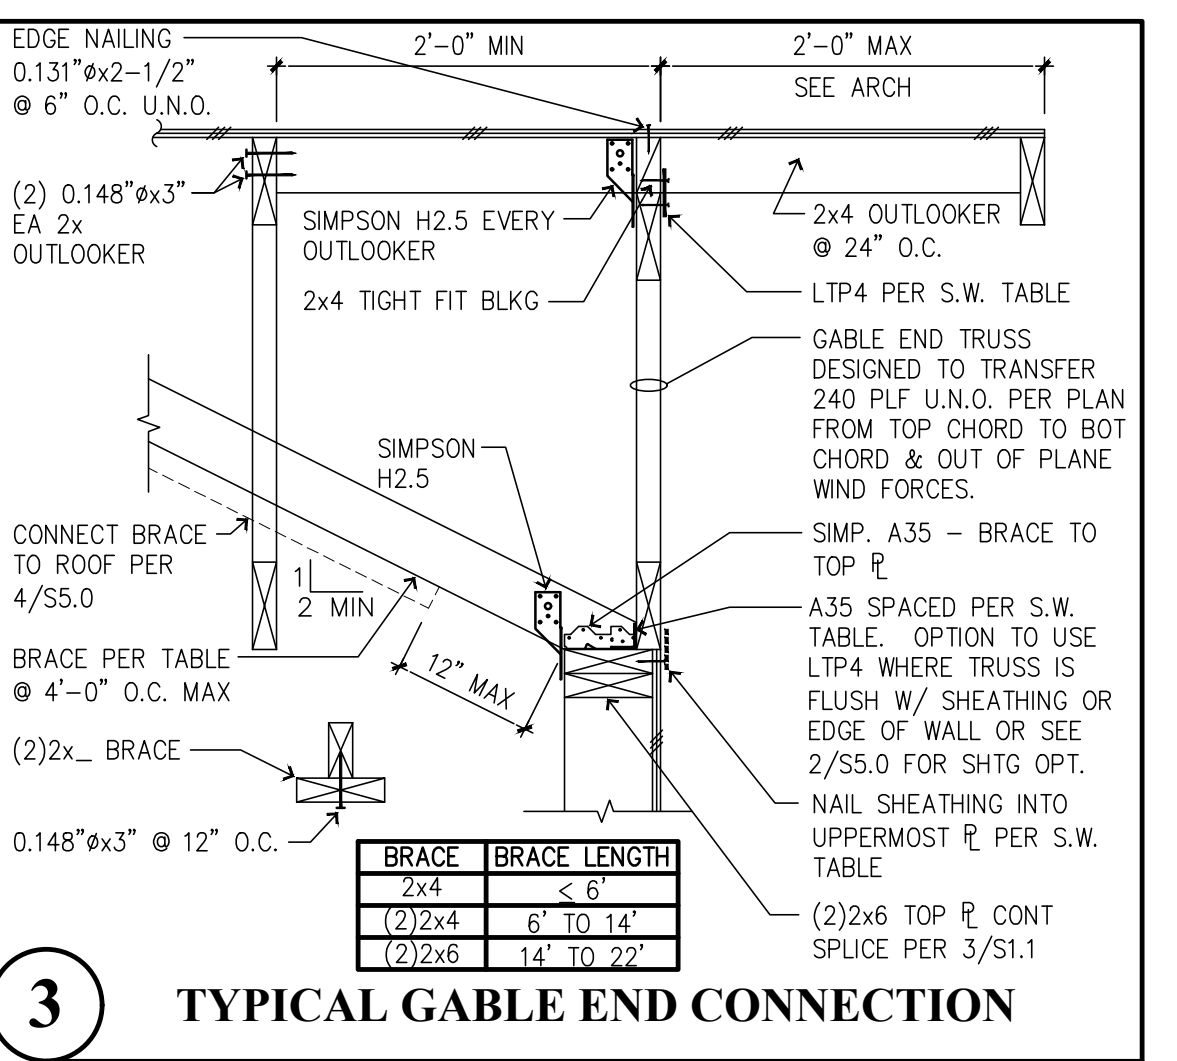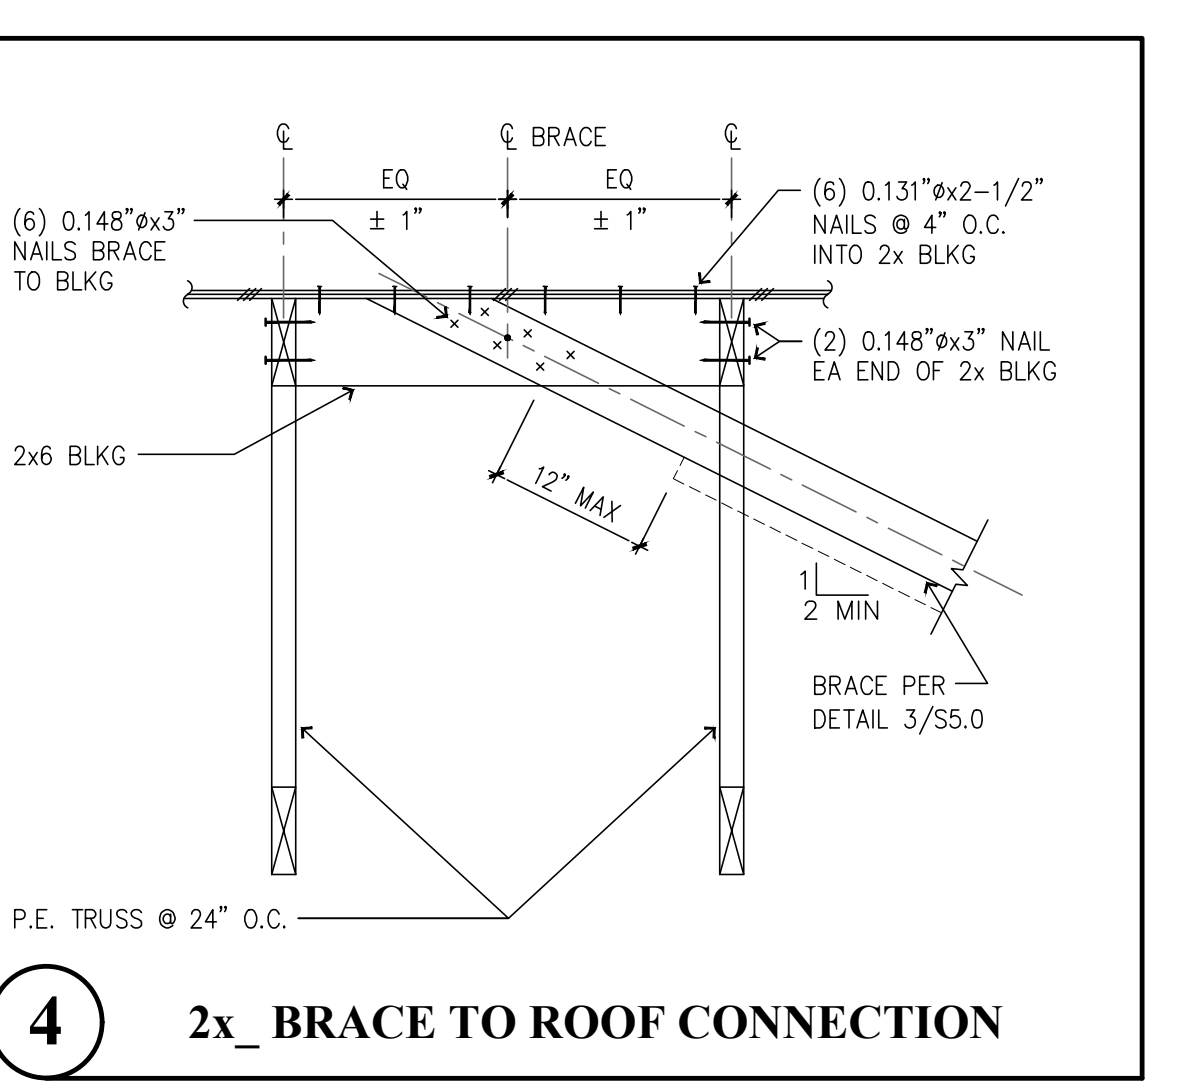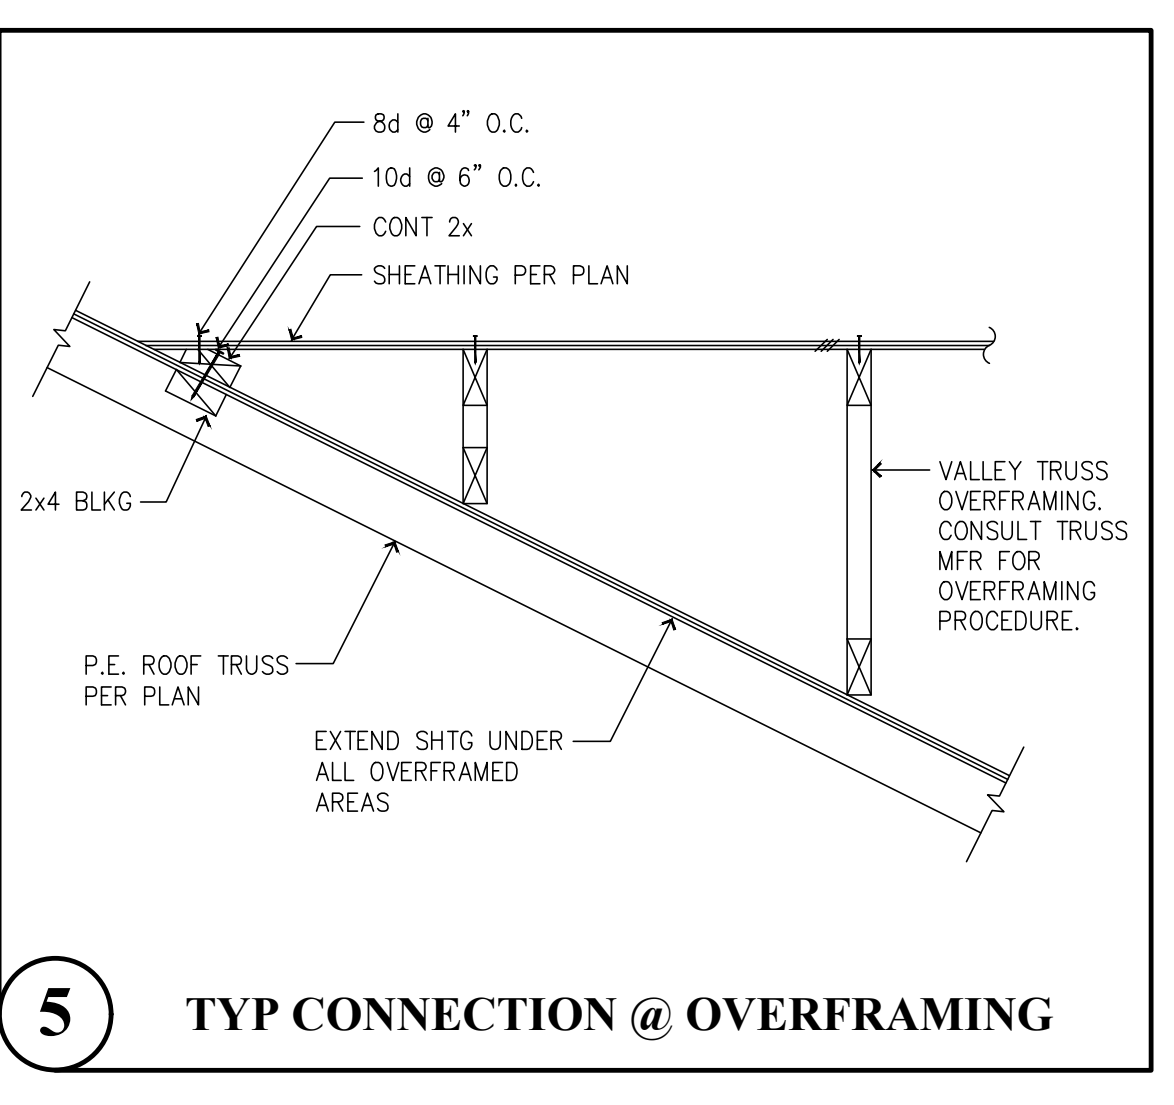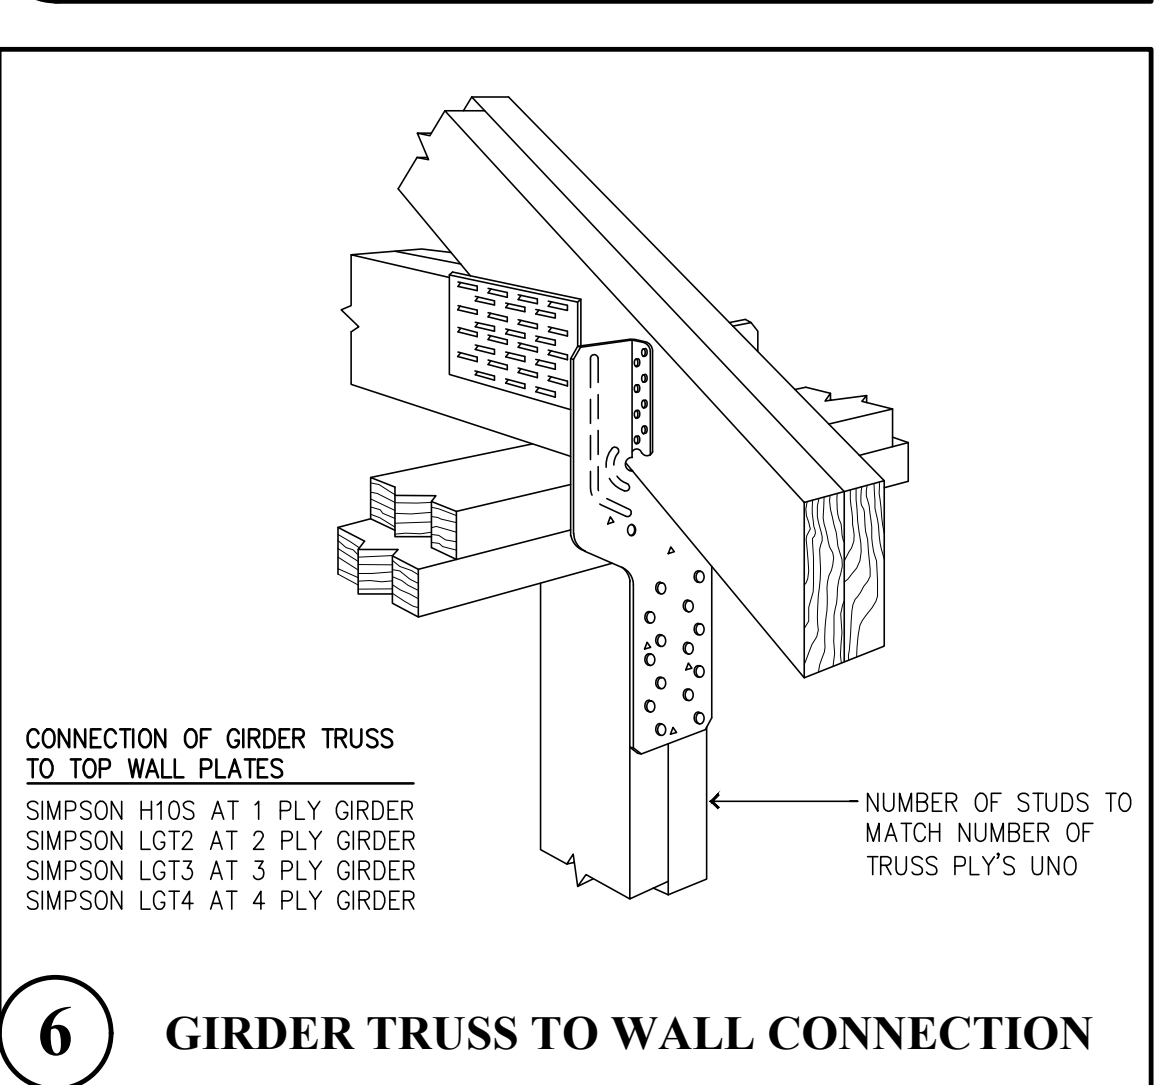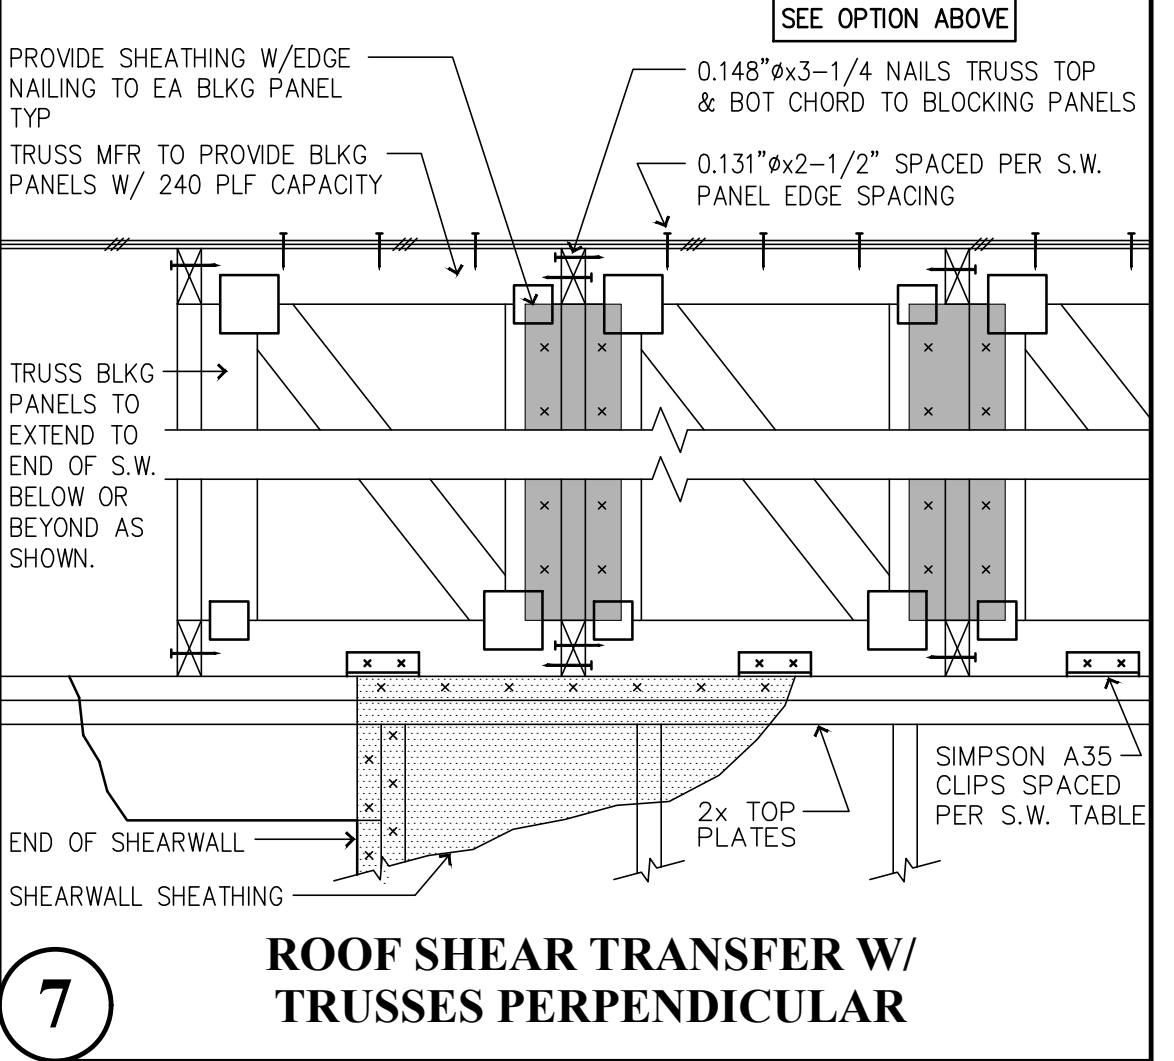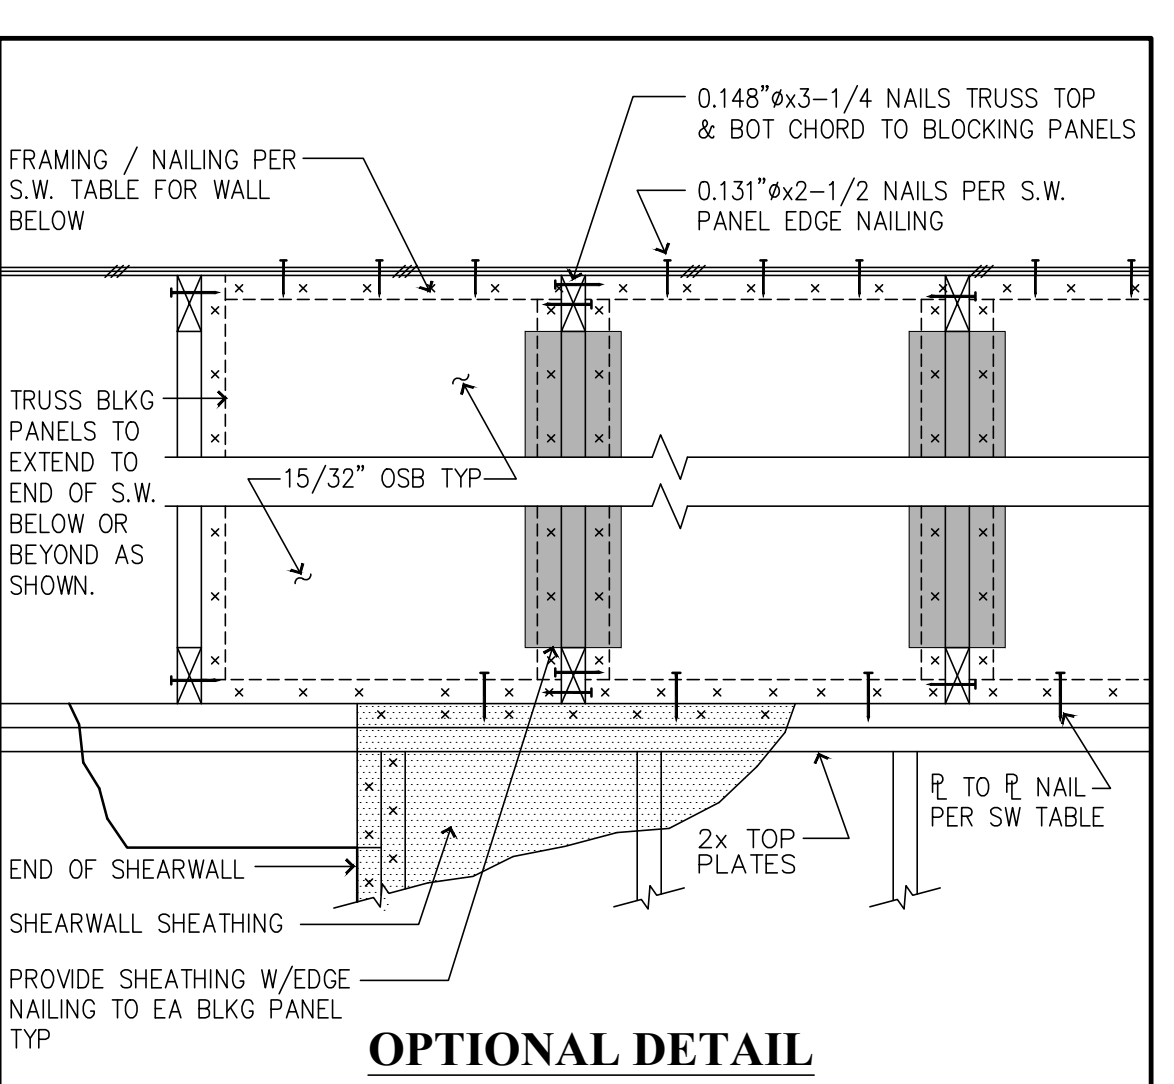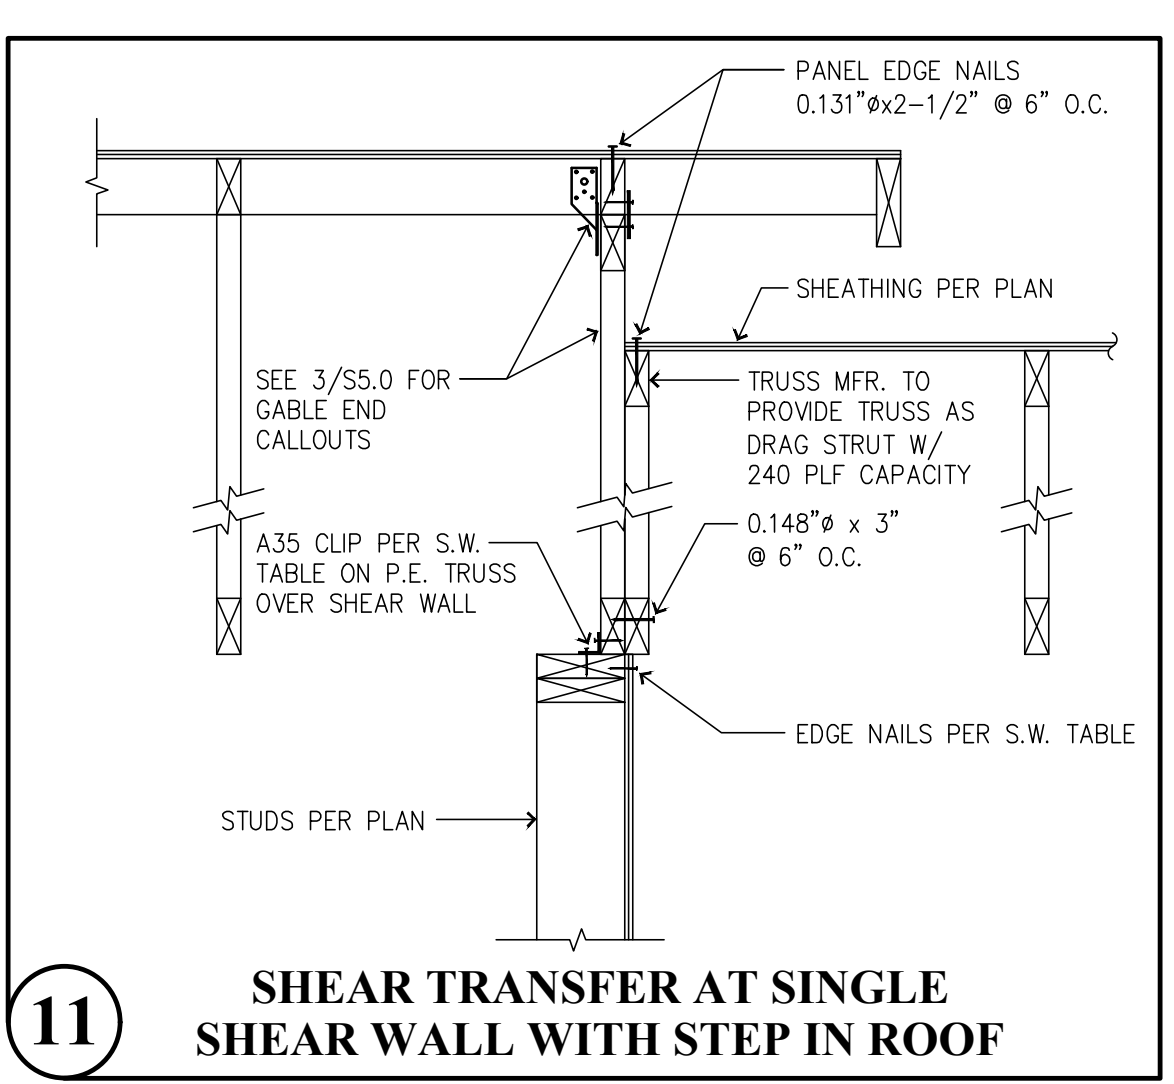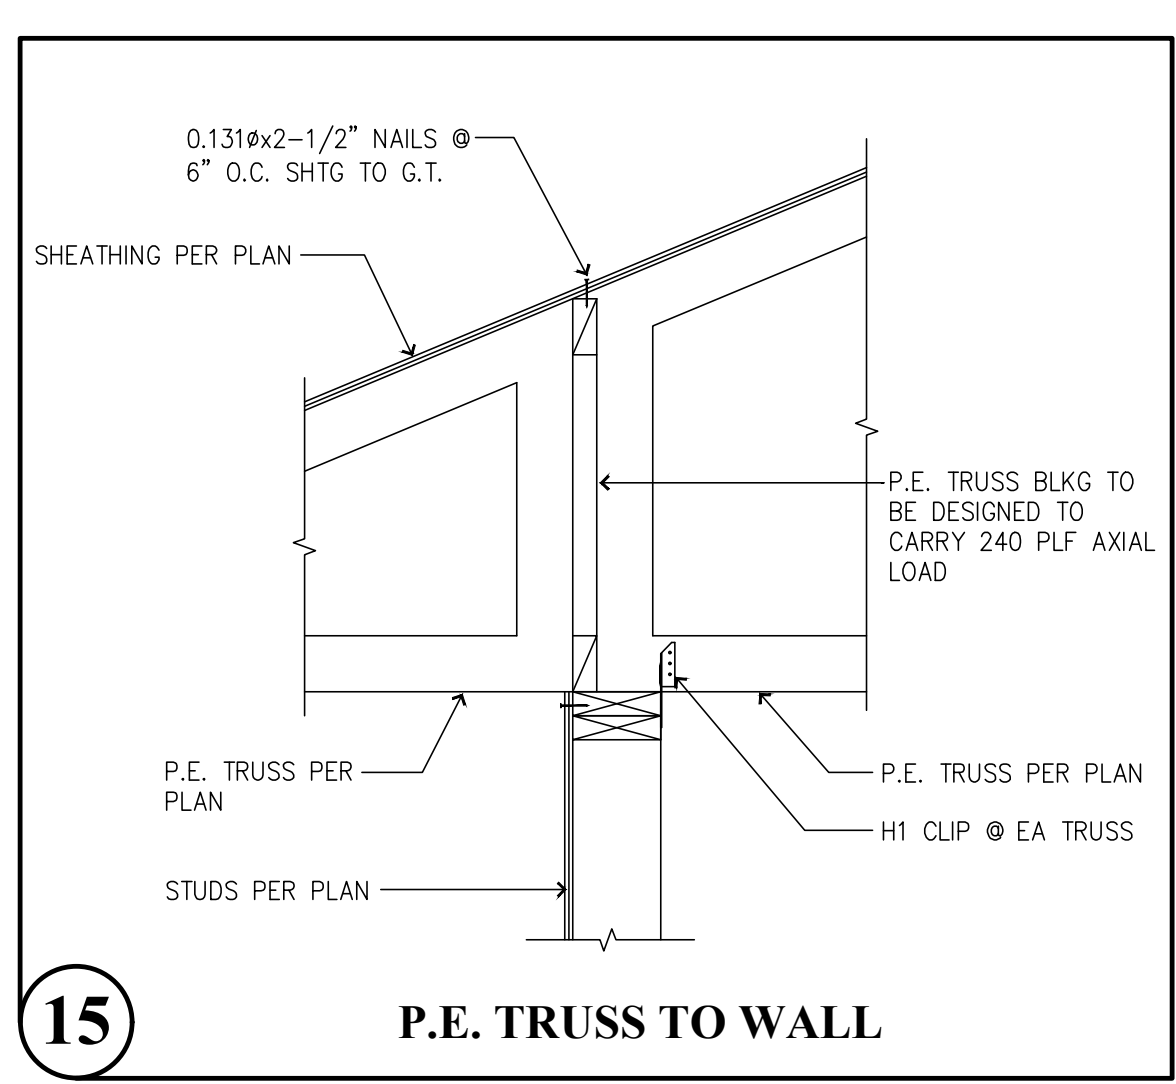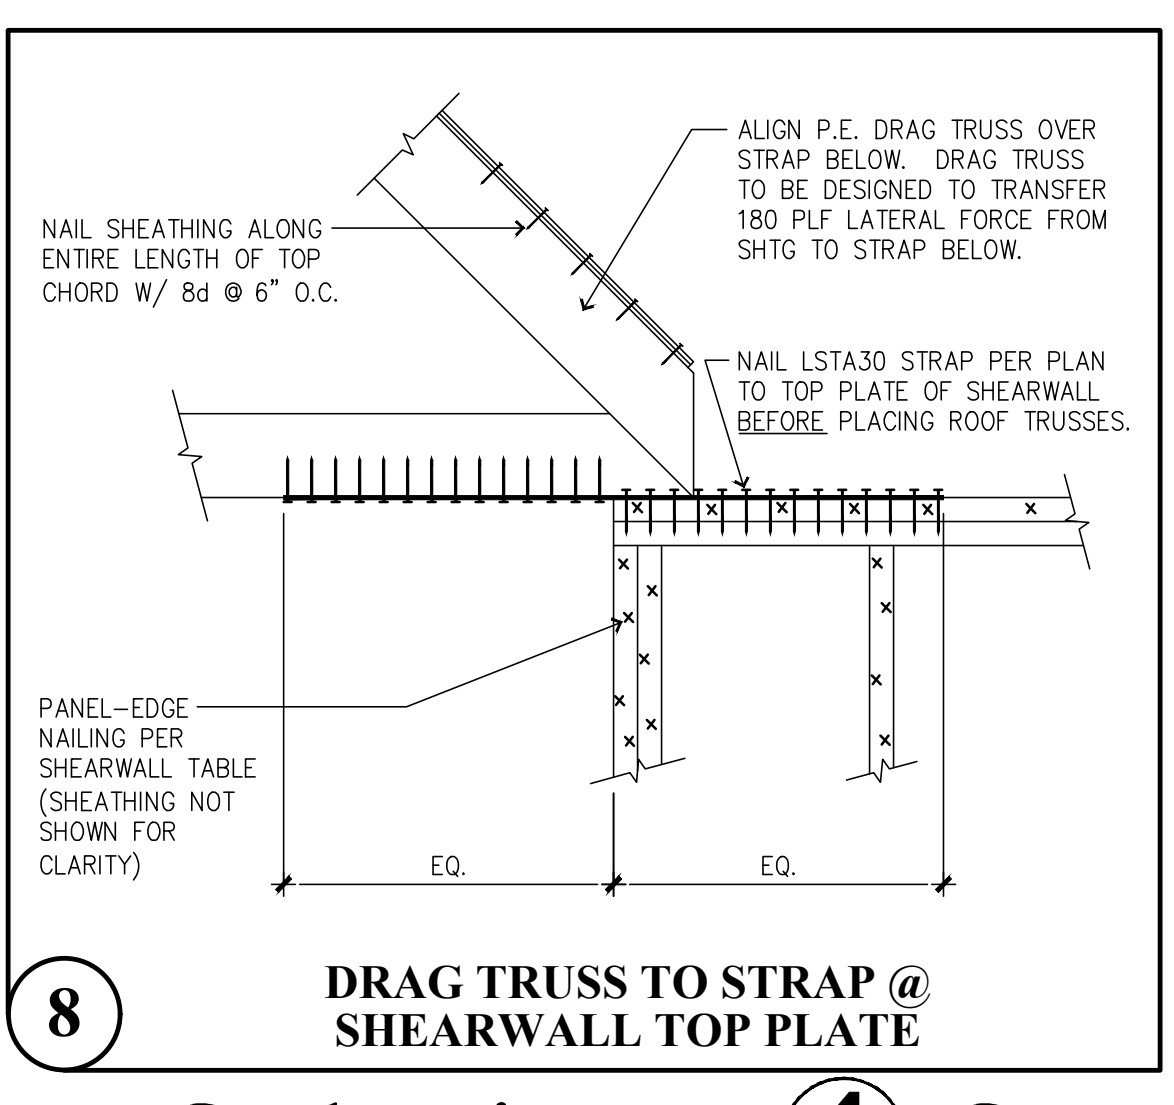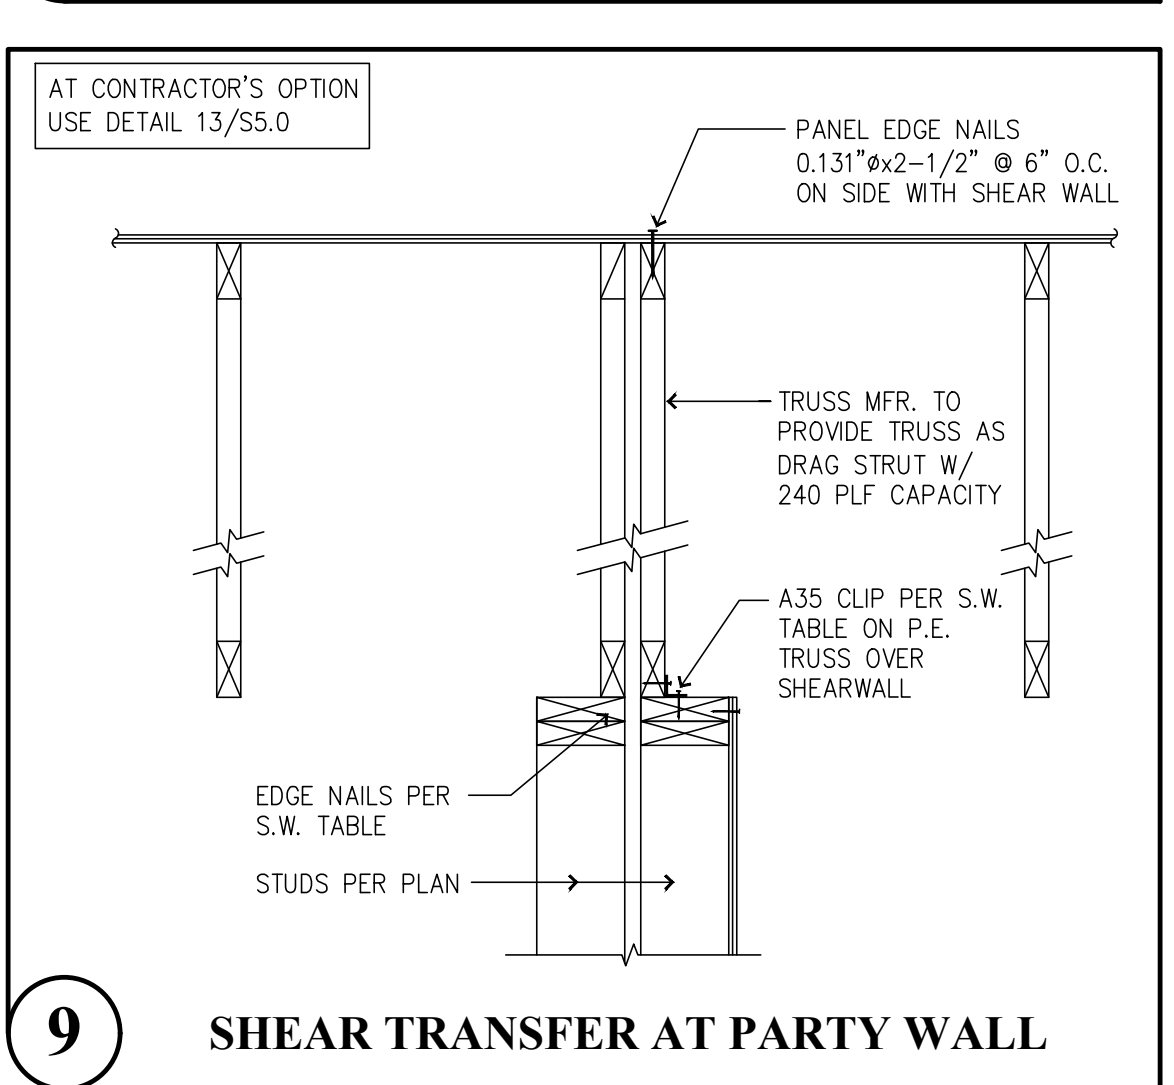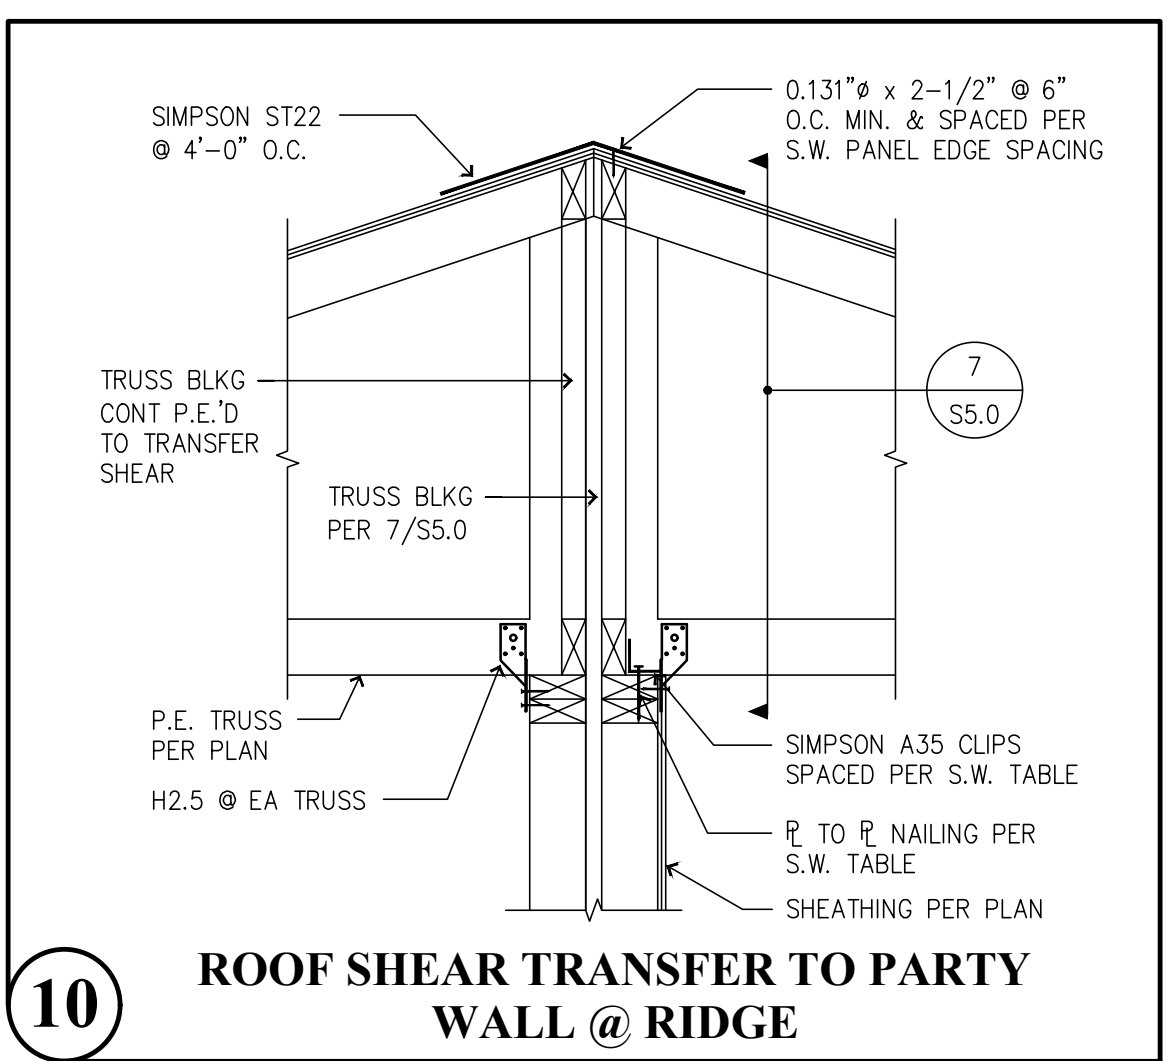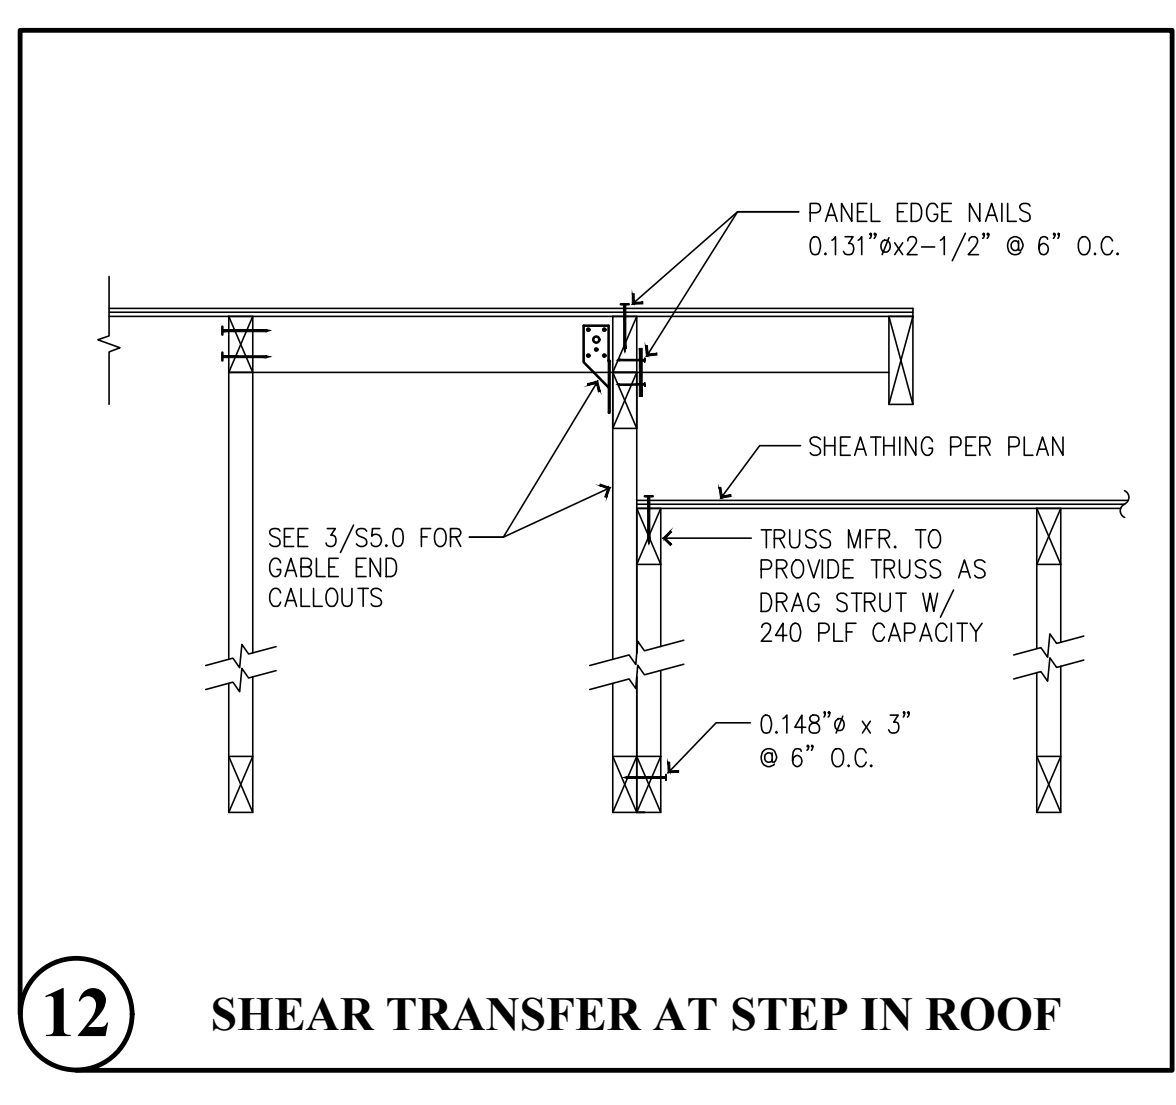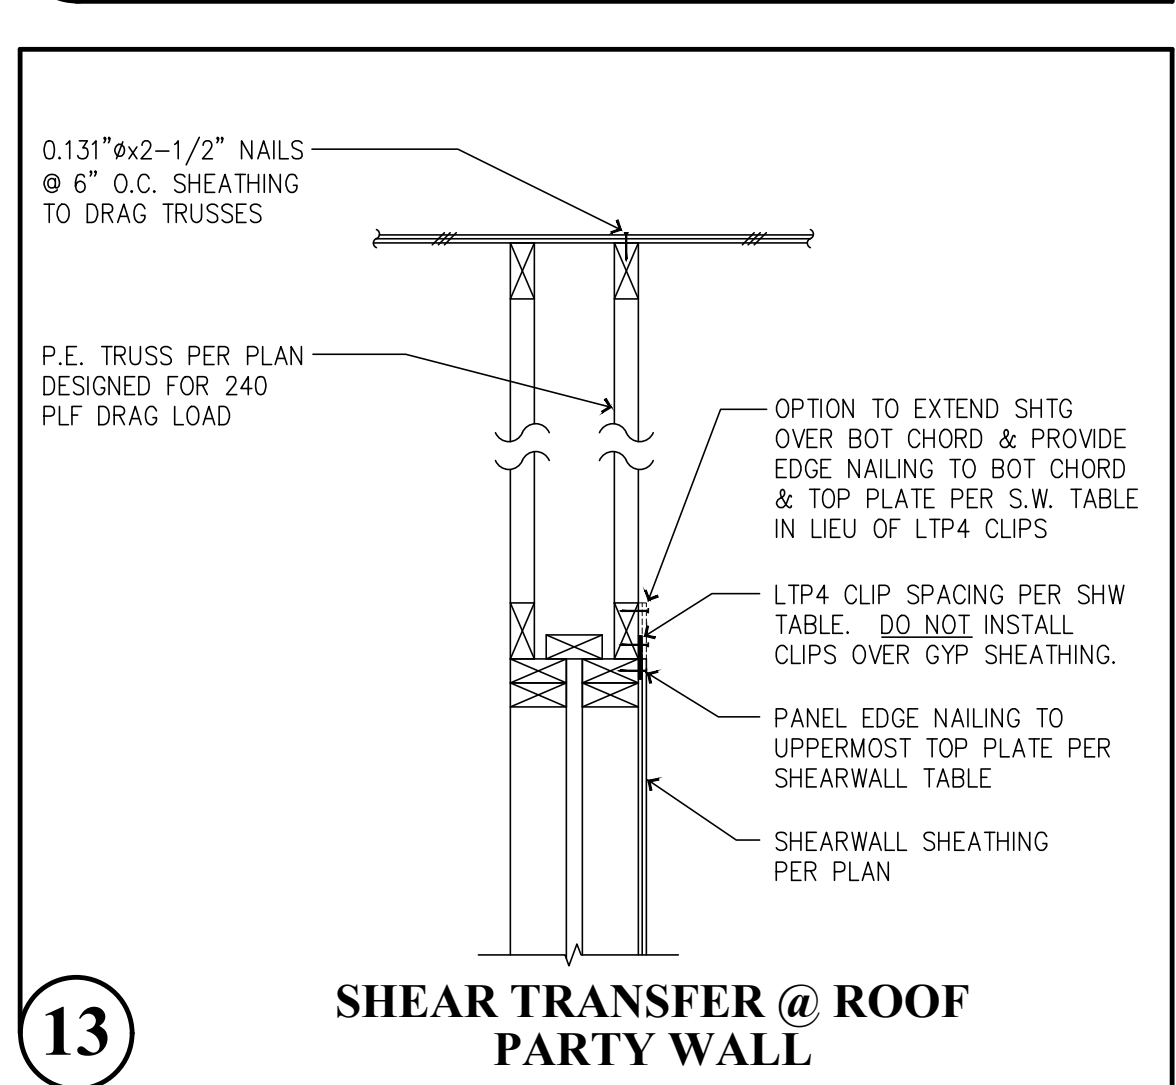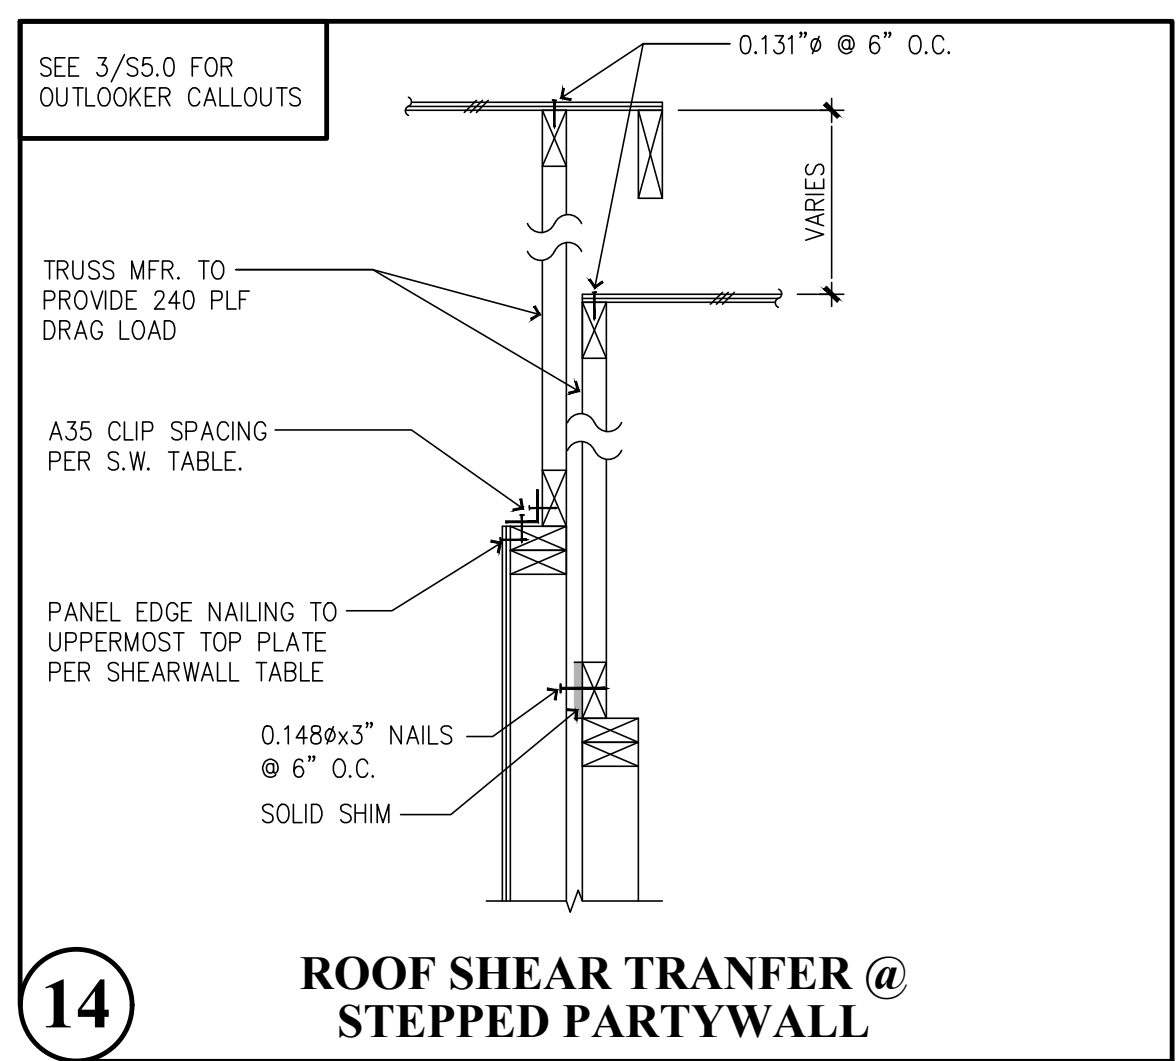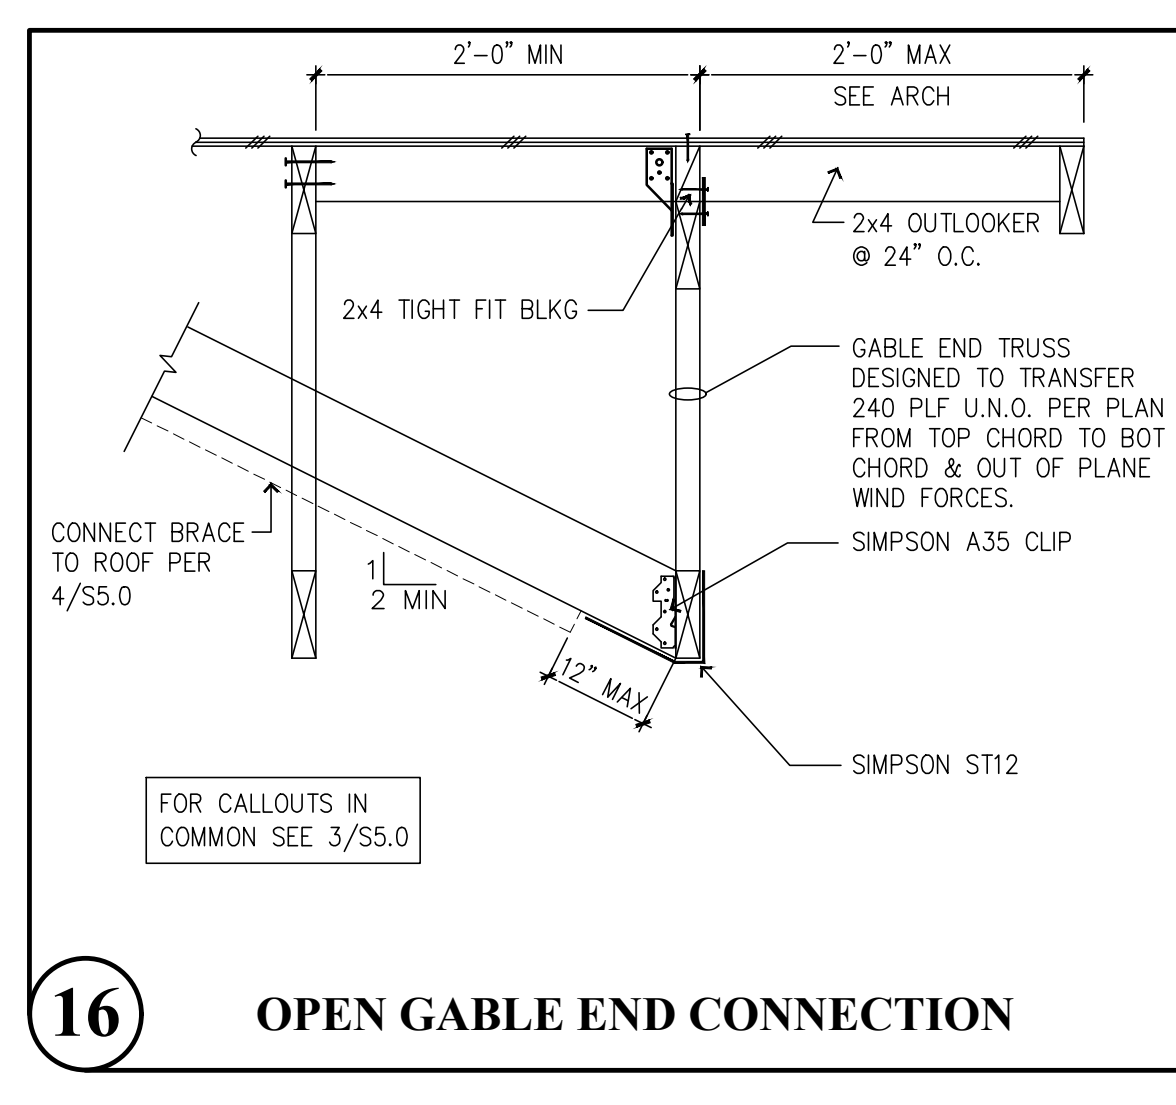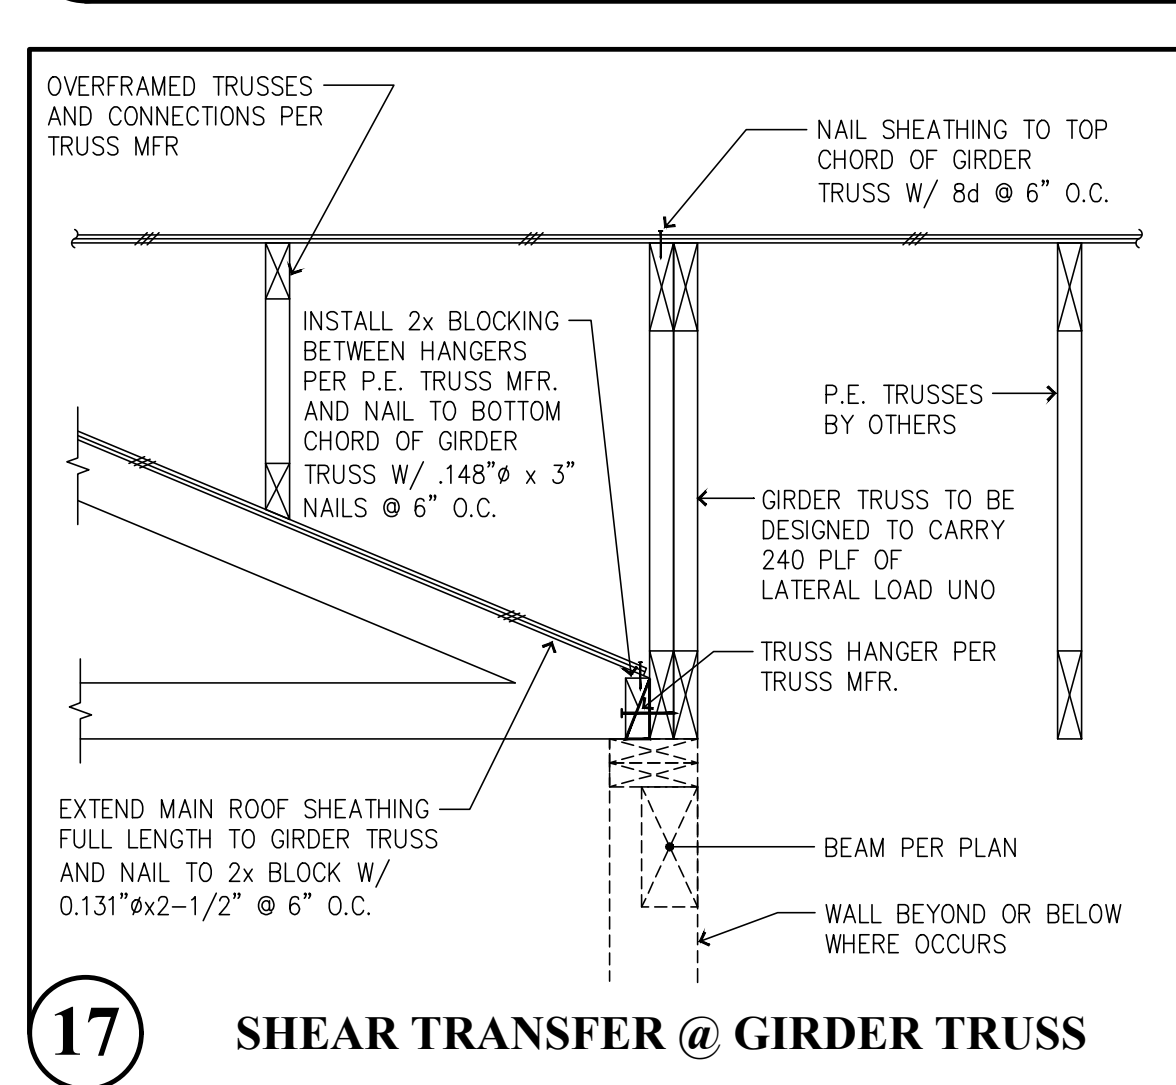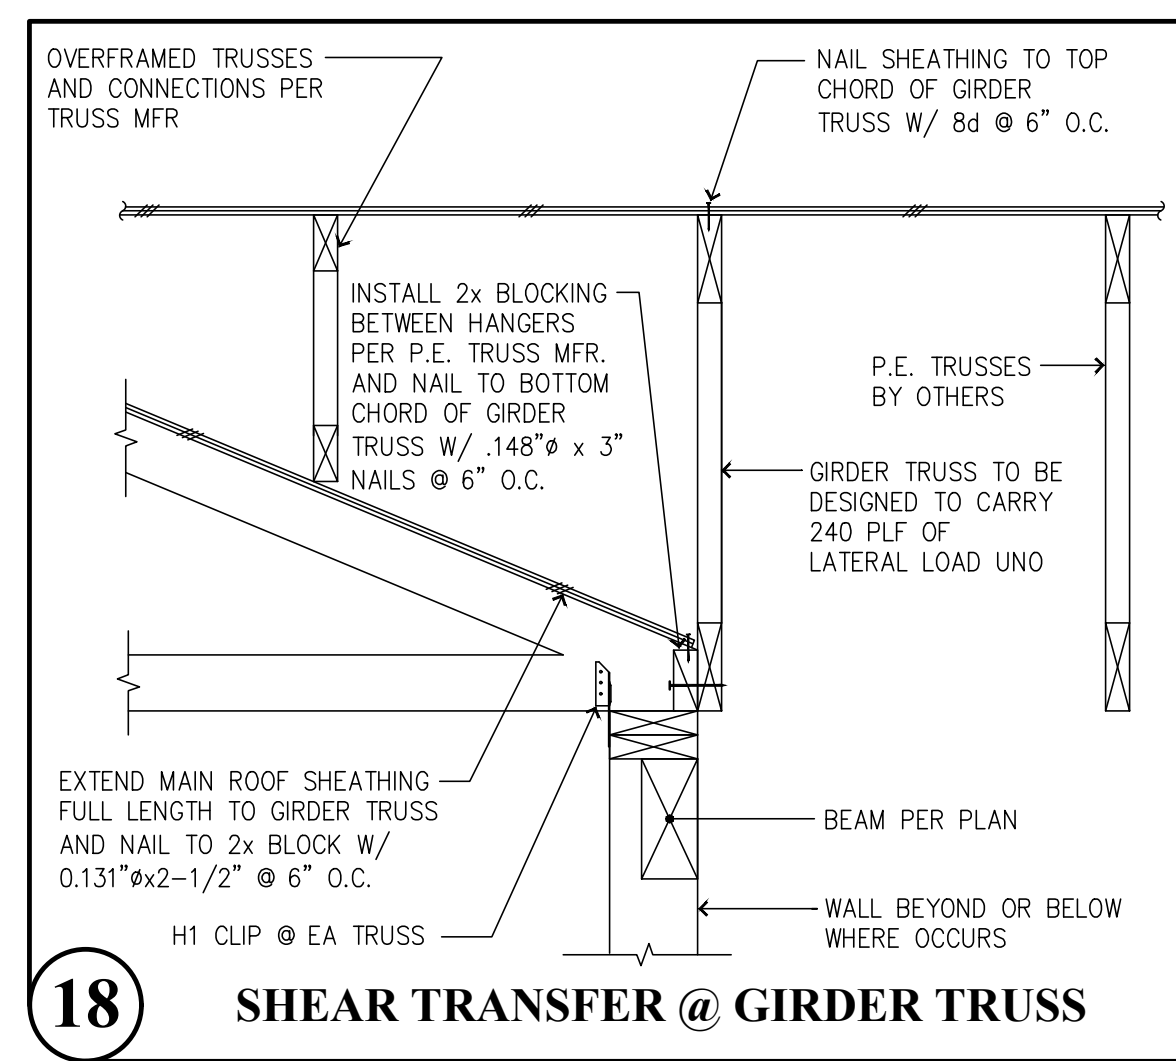

Revisions to this sheet:


Bradley Heights Apartments
 202 27th Ave SE
 Puyallup, Washington

Solutions 4 Structures
 A Structural Engineering Corporation

Puyallup, Washington 98374
 Ph: 253-314-9822
 www.solutions4structures.com

PROJECT NO. : 23.007
 DESIGNED BY : TLC, OGG, MRO
 DRAWN BY : RSO
 ISSUE DATE : 2-20-24
 LATEST REV. OF DWG. SET :

SUBMITTAL SET ONLY NOT FOR CONSTRUCTION
 THESE DRAWINGS ARE SUBJECT TO REVISIONS
 PENDING LOCAL JURISDICTIONAL REVIEW.

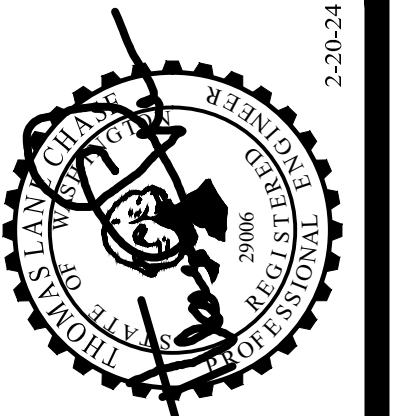

2-20-24
 THOMAS L. CHASE, PE
 MARTIN R. OMAN, PE, SE
 OLEG G. KONDRATYUK, PE

Revisions to this sheet:

Bradley Heights Apartments
 202 27th Ave SE
 Puyallup, Washington







Puyallup, Washington 98374
 Ph 253-314-9822
 www.solutions4structures.com


Solutions 4 Structures
 A Structural Engineering Corporation

PROJECT NO. : 23.007
 DESIGNED BY : TLC, OGG, MRO
 DRAWN BY : RSO
 ISSUE DATE : 2-20-24
 LATEST REV. OF DWG. SET :

SUBMITTAL SET ONLY NOT FOR CONSTRUCTION
 THESE DRAWINGS ARE SUBJECT TO REVISIONS
 PENDING LOCAL JURISDICTIONAL REVIEW.

S5.1

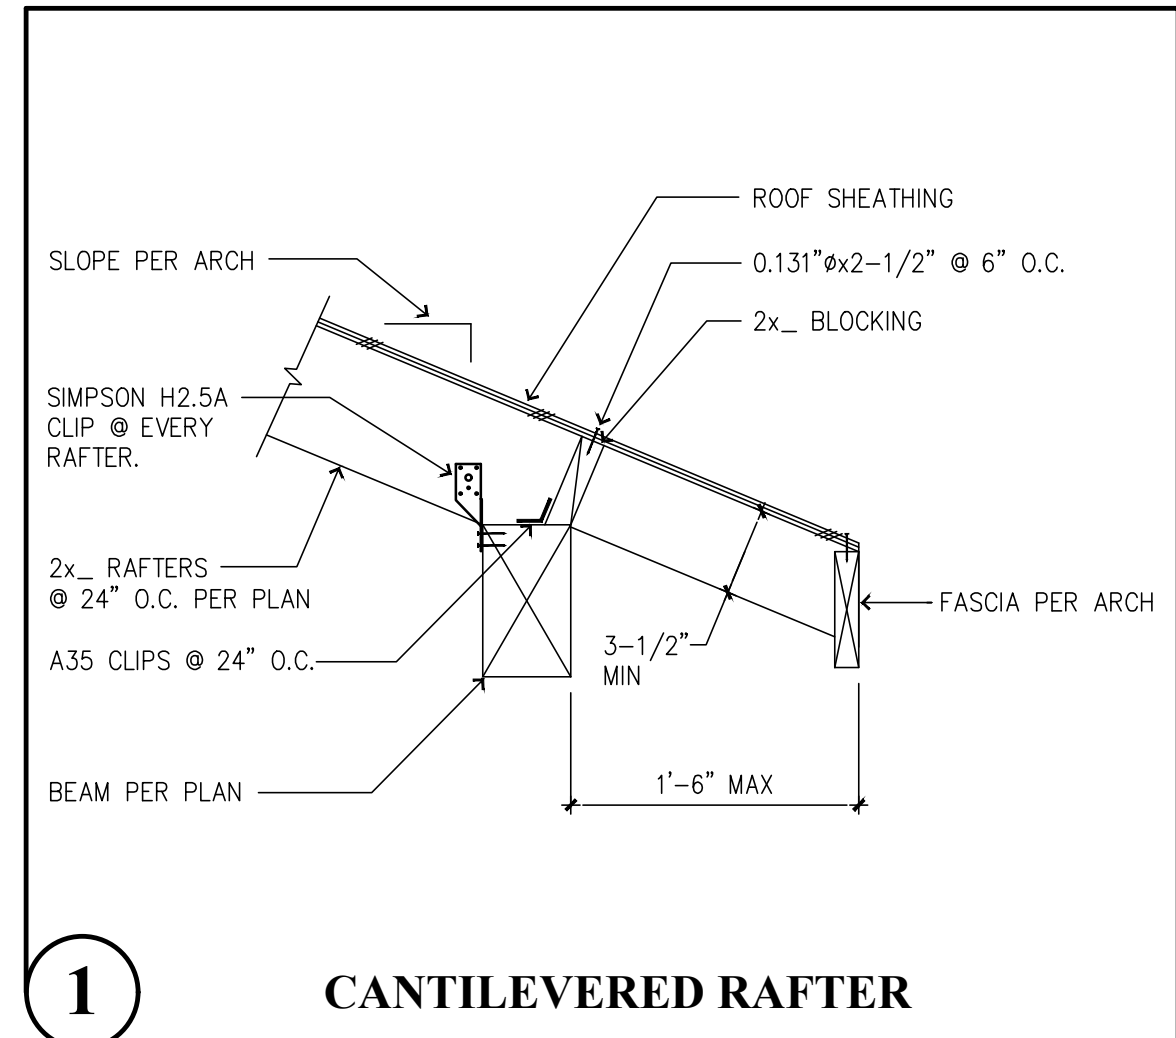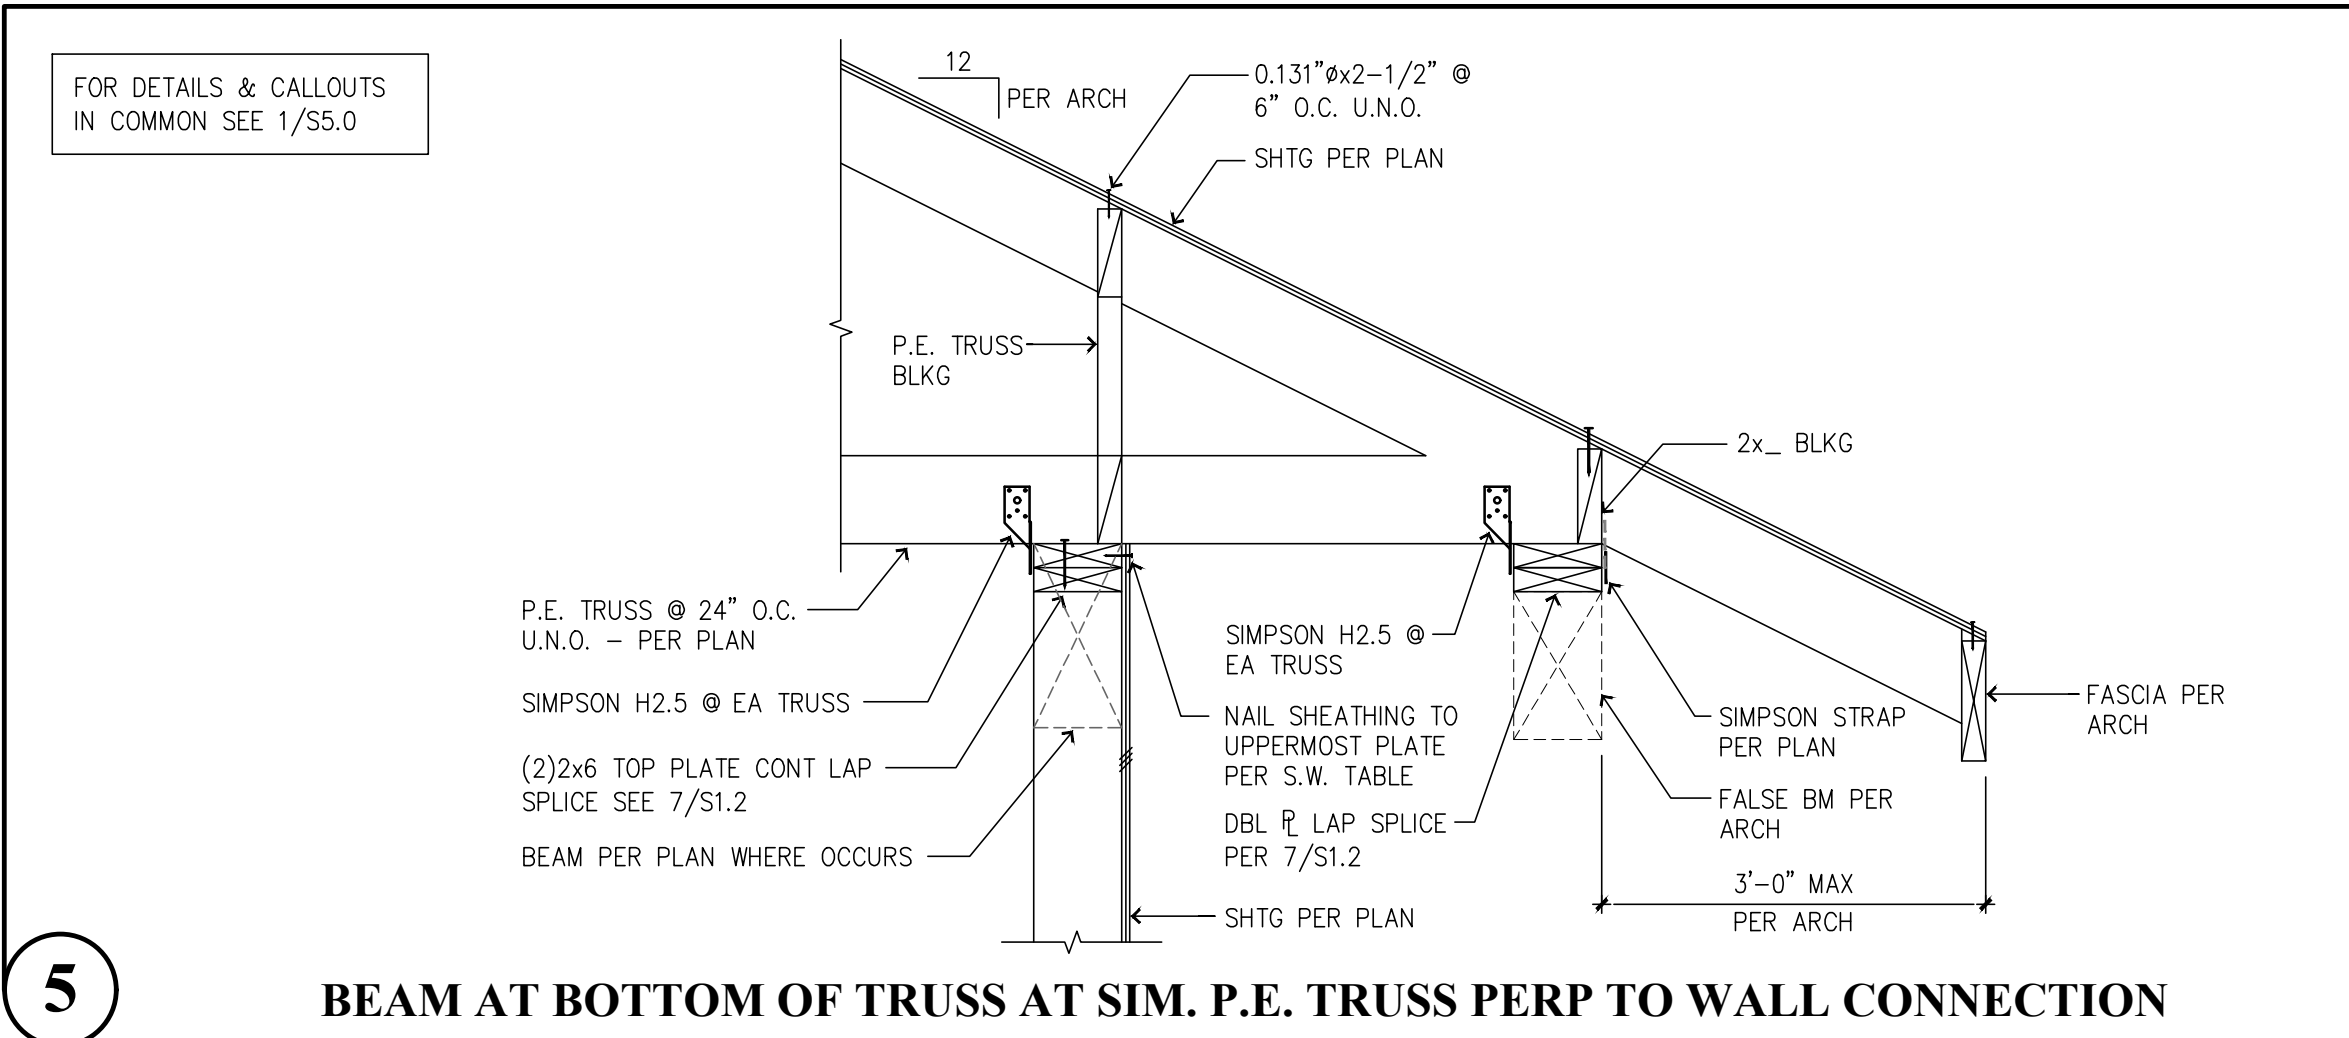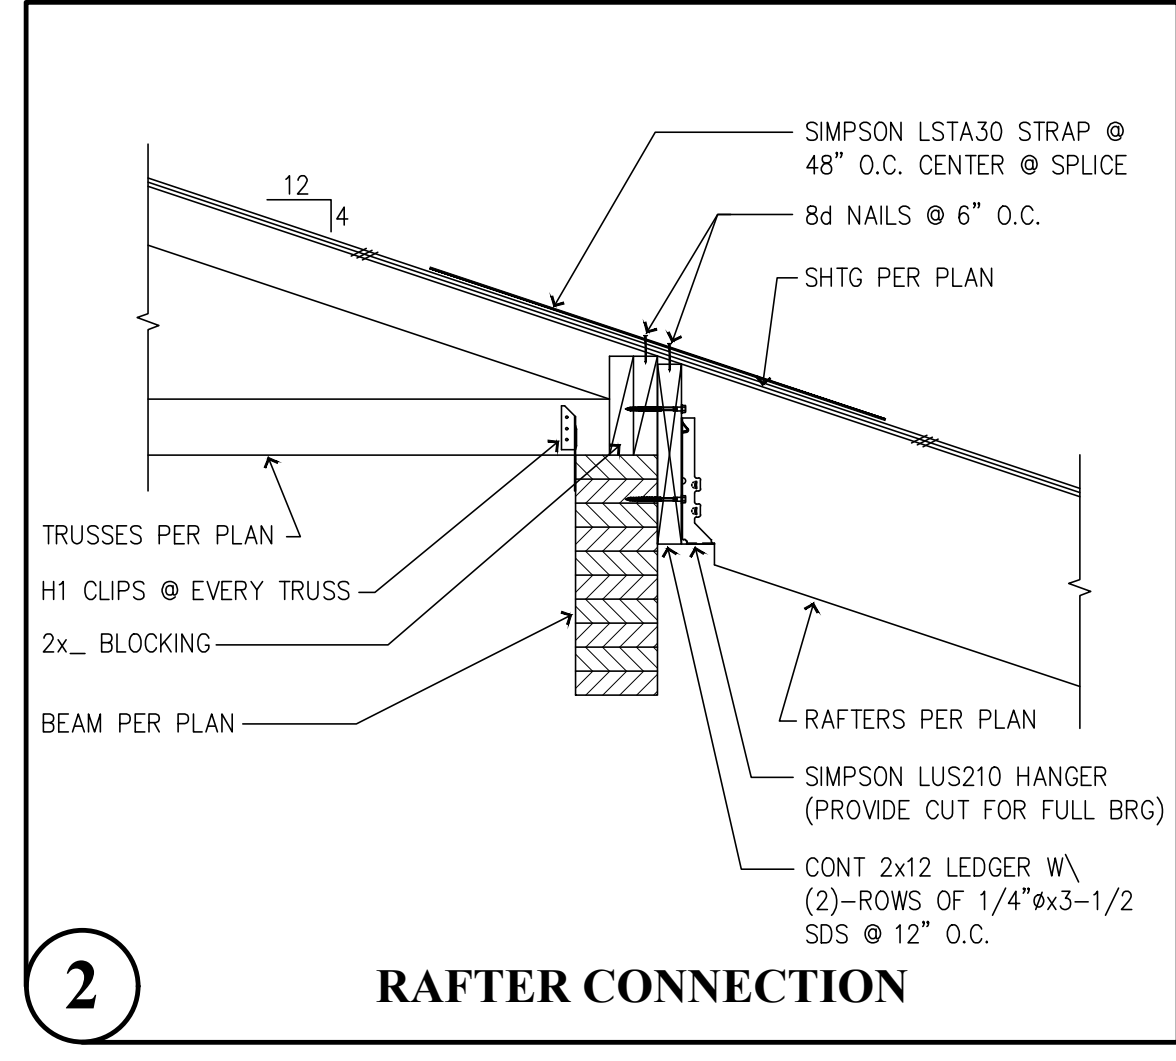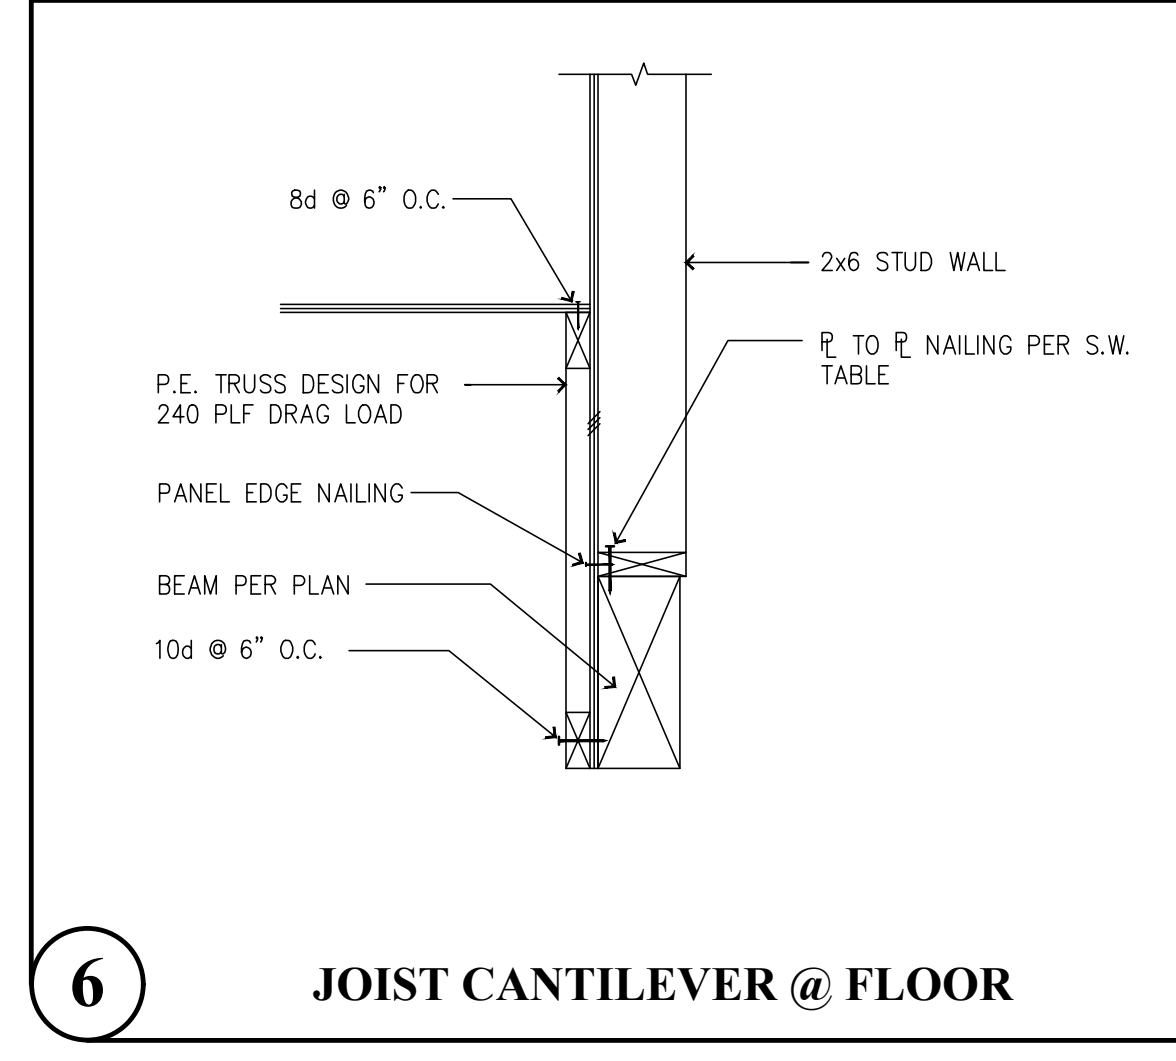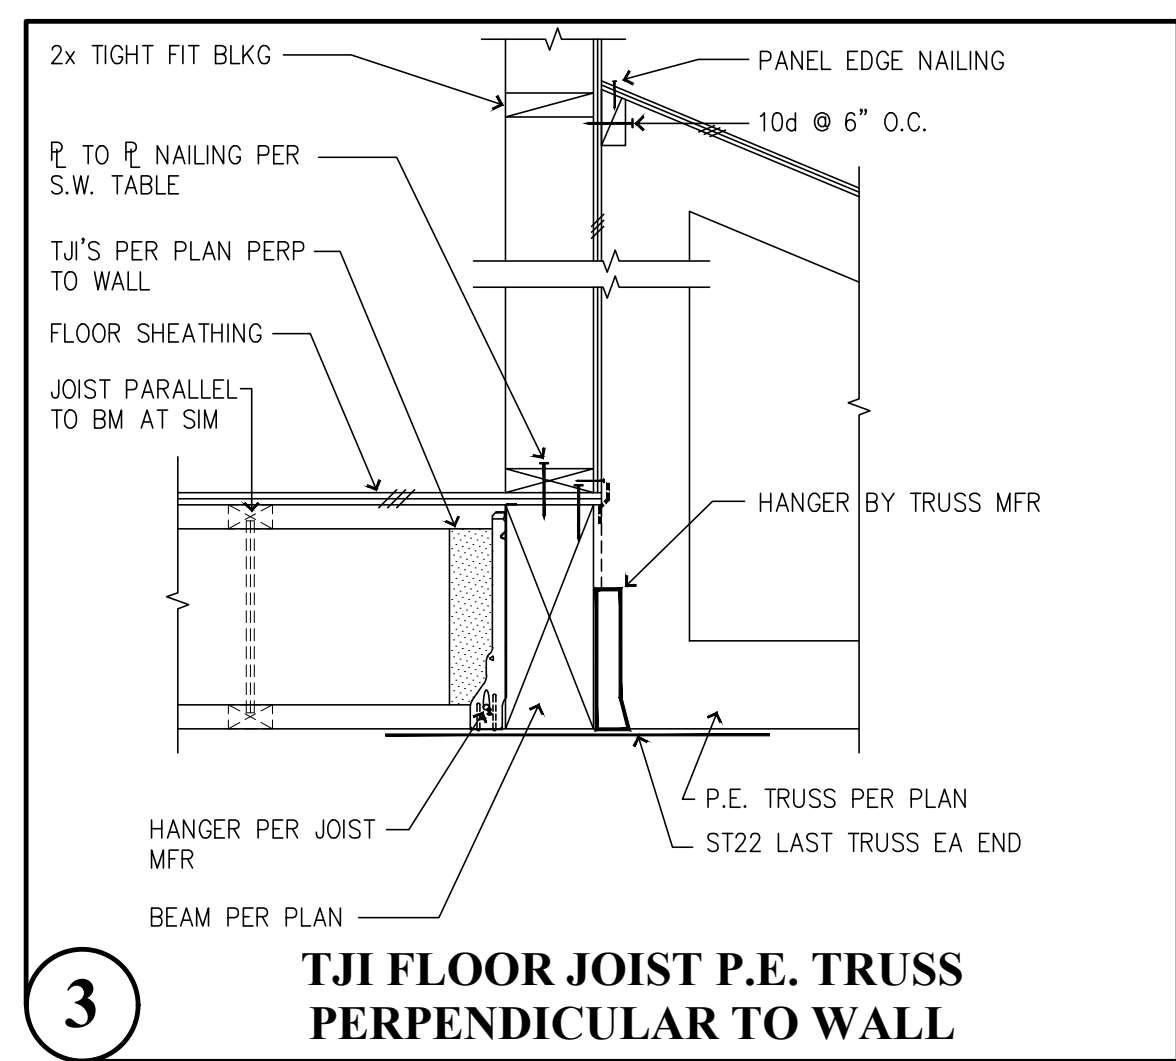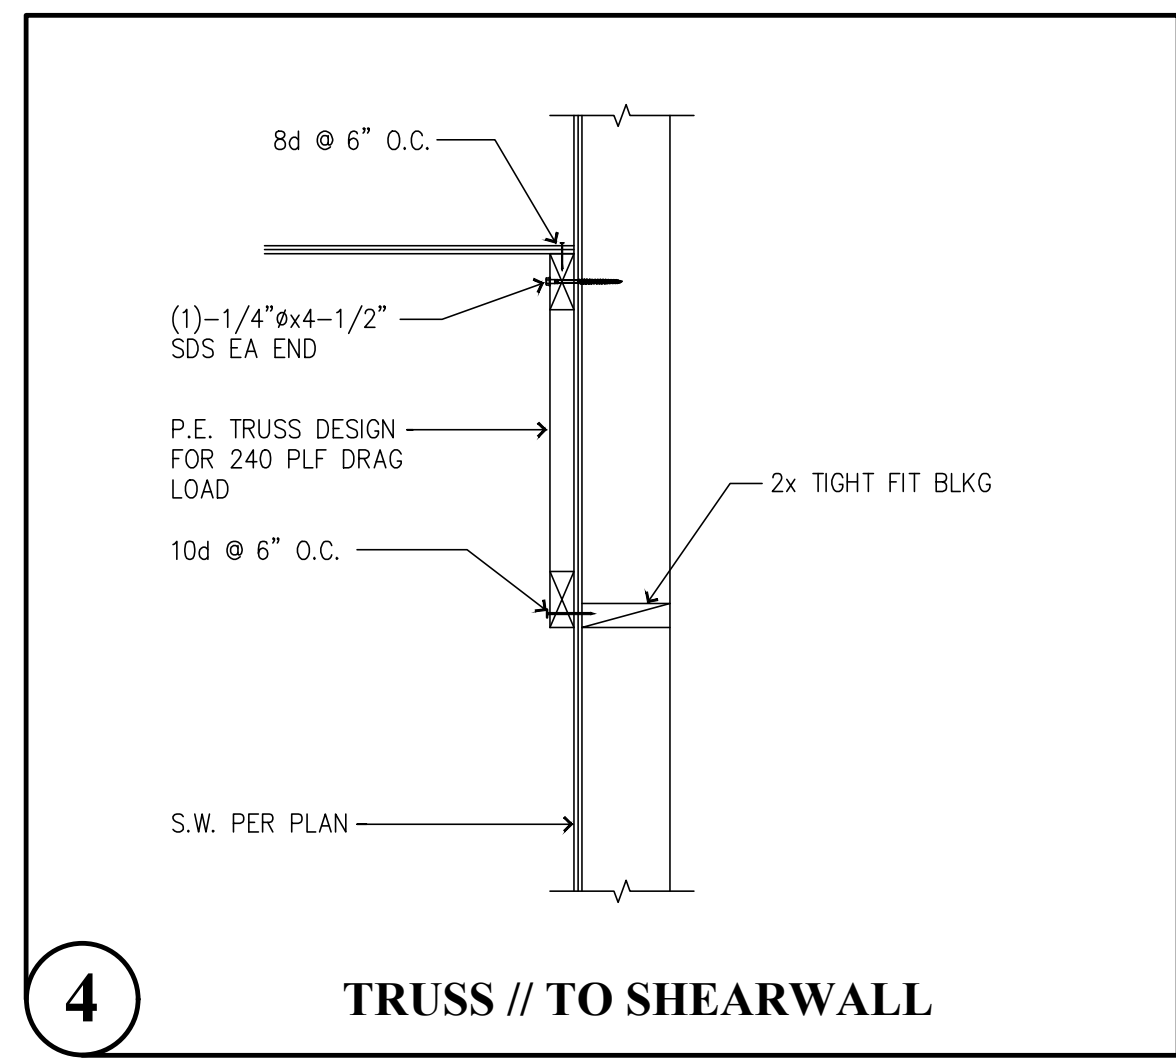


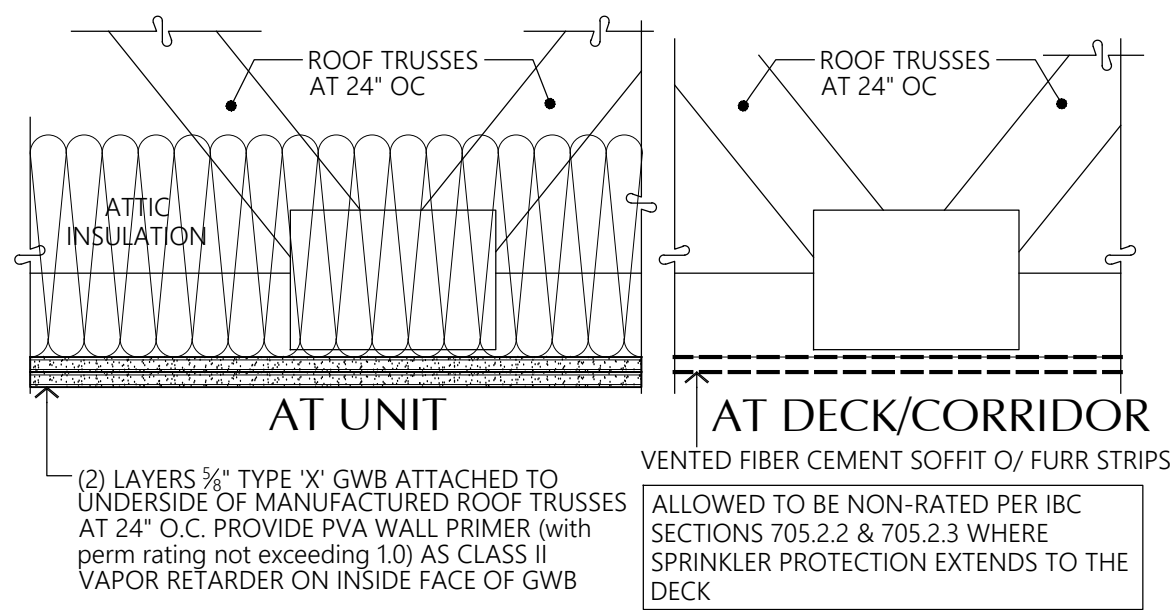

1-HR GA File No. RC 2602
 Base layer 5/8\"/>

17 TYPICAL 1-HR ROOF/CEILING
 1-1/2\"/>


- 1-HR ESR-1153 Assembly B, Sound Rating Option 2**
- The flooring must consist of a single layer of 3/4\"/>
 - TJI joists must be installed with a maximum spacing of 24\"/>
 - Optional minimum 3/2\"/>
 - Ceiling membrane shall be two layers of same-type gypsum board, either: 1/2\"/>
 - The first layer of gypsum board must be installed perpendicular to the TJI joist and attached using 1\"/>
 - Resilient channels are required to be used as part of the ceiling attachment system, provided they are spaced 16\"/>

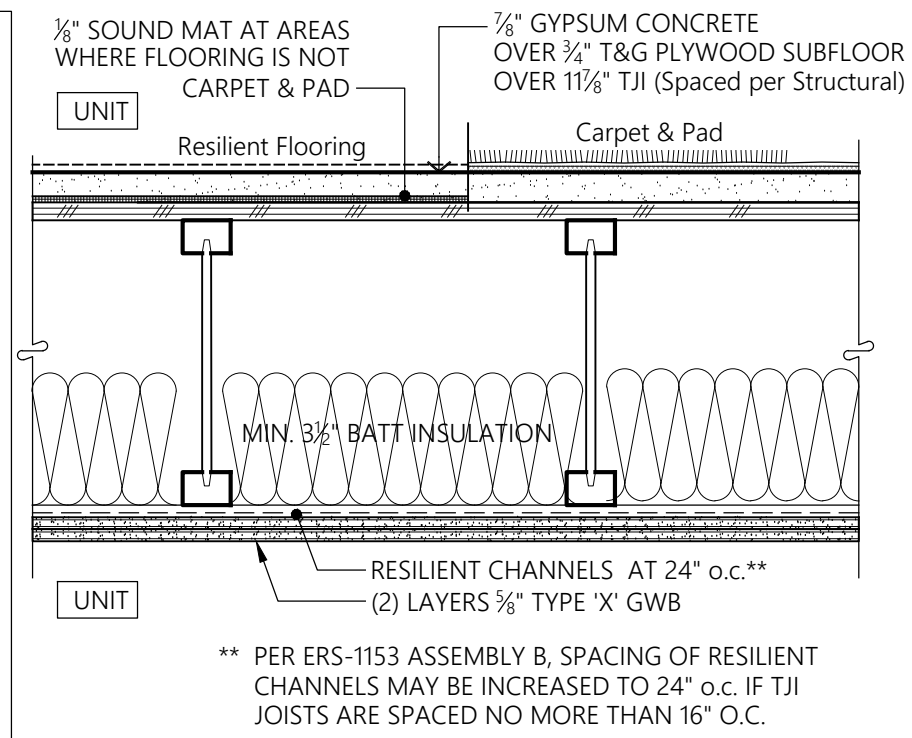

STC = 58 per ICC-ES Evaluation Report IIC = 54 With Carpet & Pad


13 TYP. 1-HR FLOOR/CEILING AT DWELLING UNITS
 1-1/2\"/>

SECTION

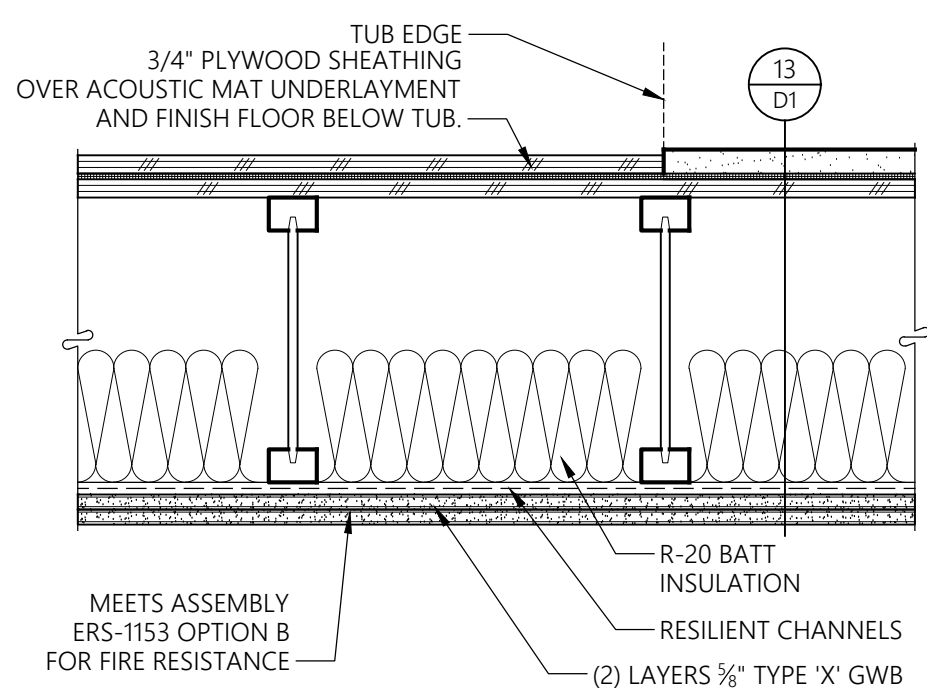

14 FLOOR BENEATH TUB
 1 1/2\"/>


SECTION

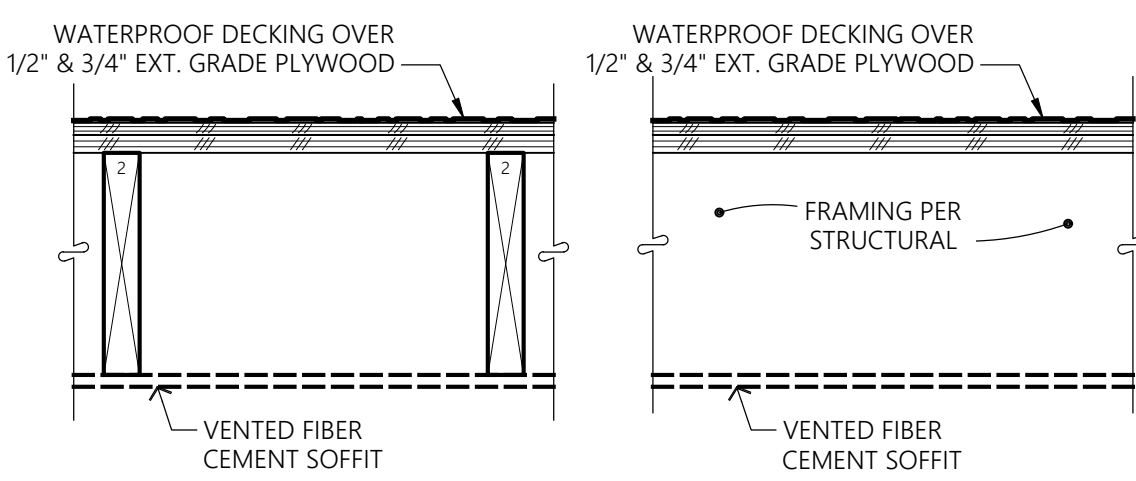

ASSEMBLY ALLOWED TO BE NON-RATED PER OSSC SECTIONS 705.2.2 AND 705.2.3 WITH FIRE SPRINKLERS PROTECTING DECK


19 FLOOR AT DECK
 1 1/2\"/>

SECTION

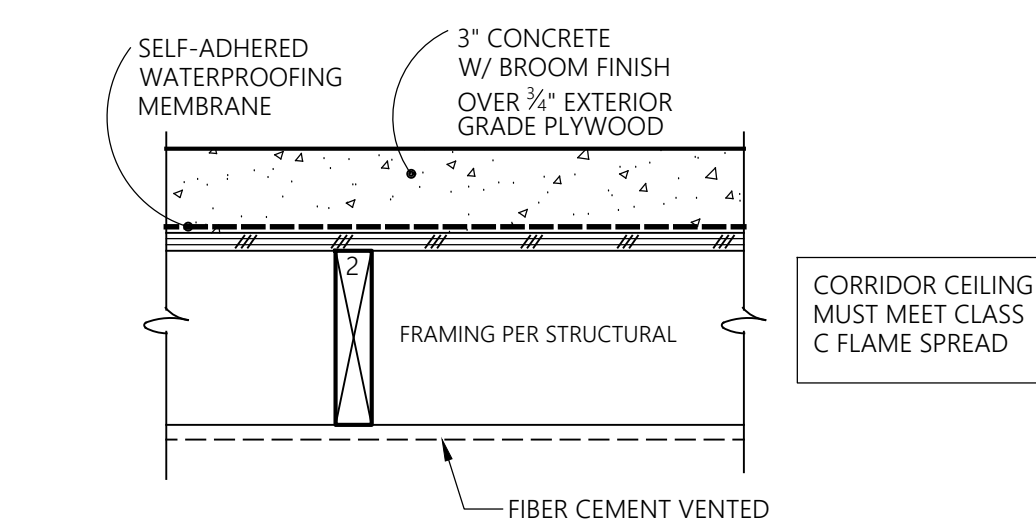


15 FLOOR AT CORRIDOR/LANDING
 1-1/2\"/>

SECTION

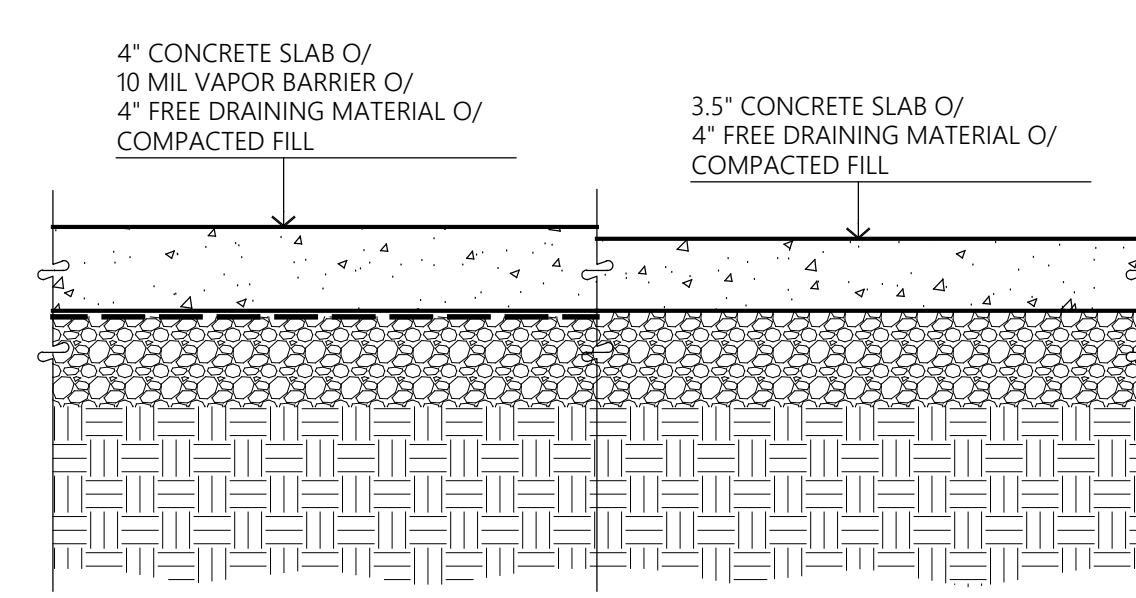


20 TYP. SLAB-ON-GRADE
 1-1/2\"/>

SECTION

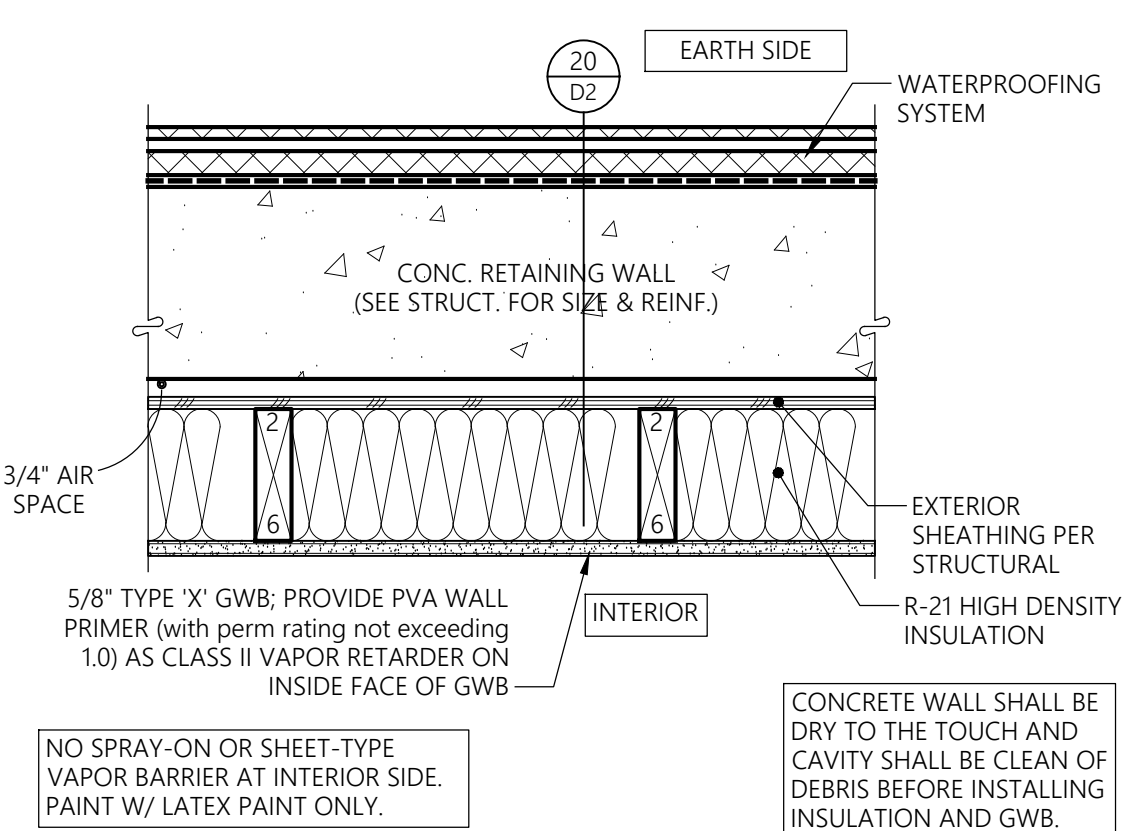


12 CONCRETE WALL @ EXTERIOR WALL
 1-1/2\"/>

PLAN

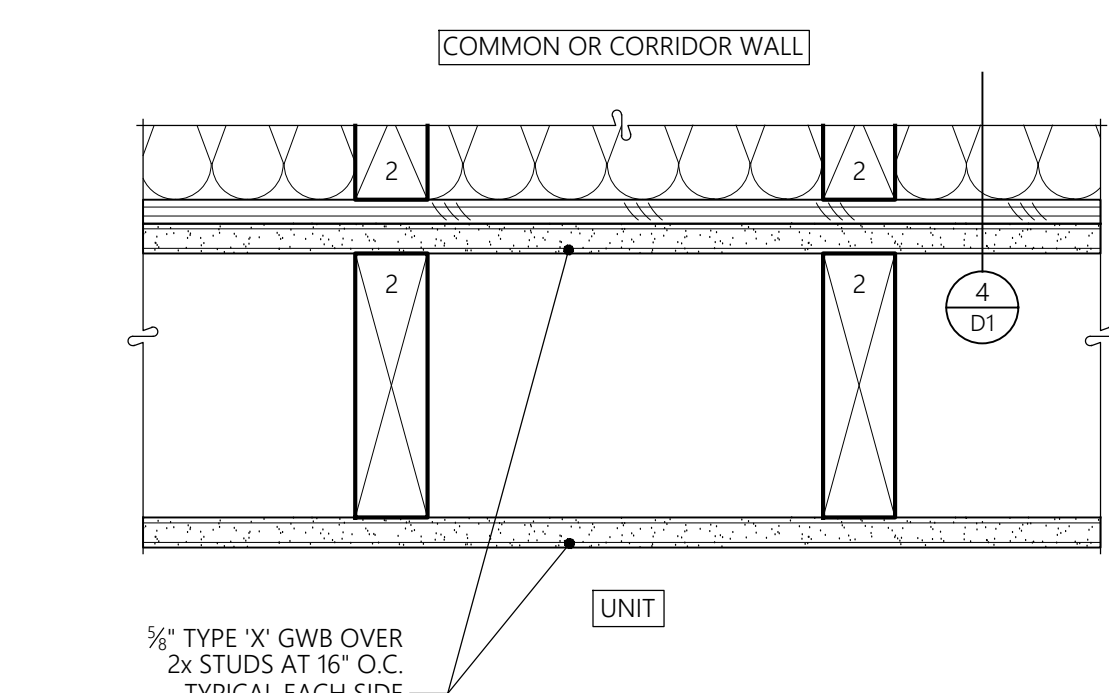

6 FURRED PLUMBING WALL
 3\"/>

PLAN

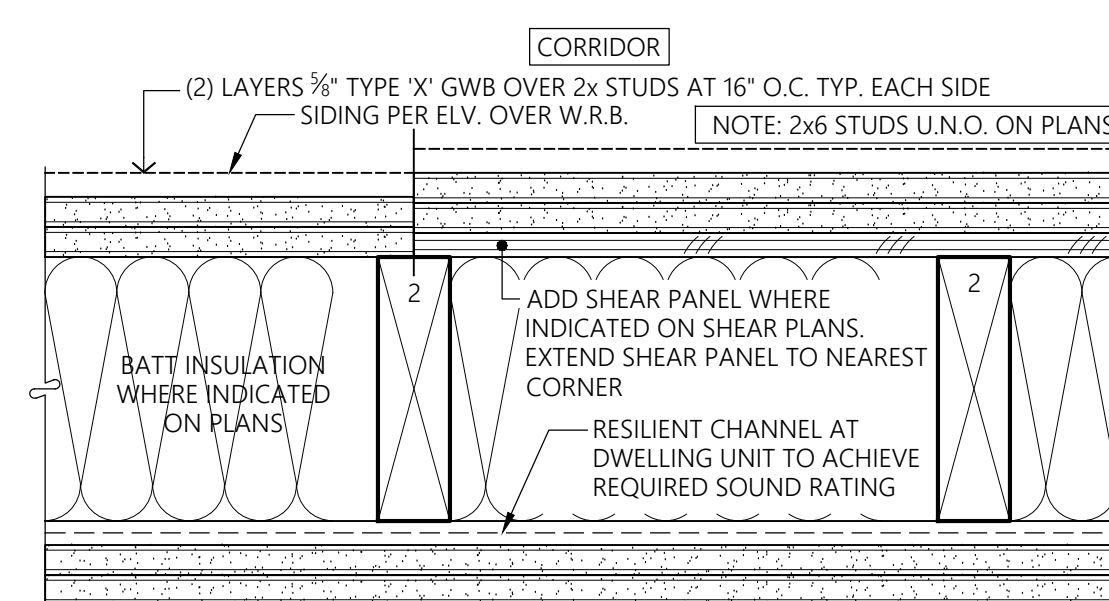


2-HR GA File No. WP4136 STC 50 (TL-93-103)

Base layer 5/8\"/>

7 TYP. 2-HR FIRE BARRIER WALL AT EXIT CORRIDOR
 3\"/>


PLAN

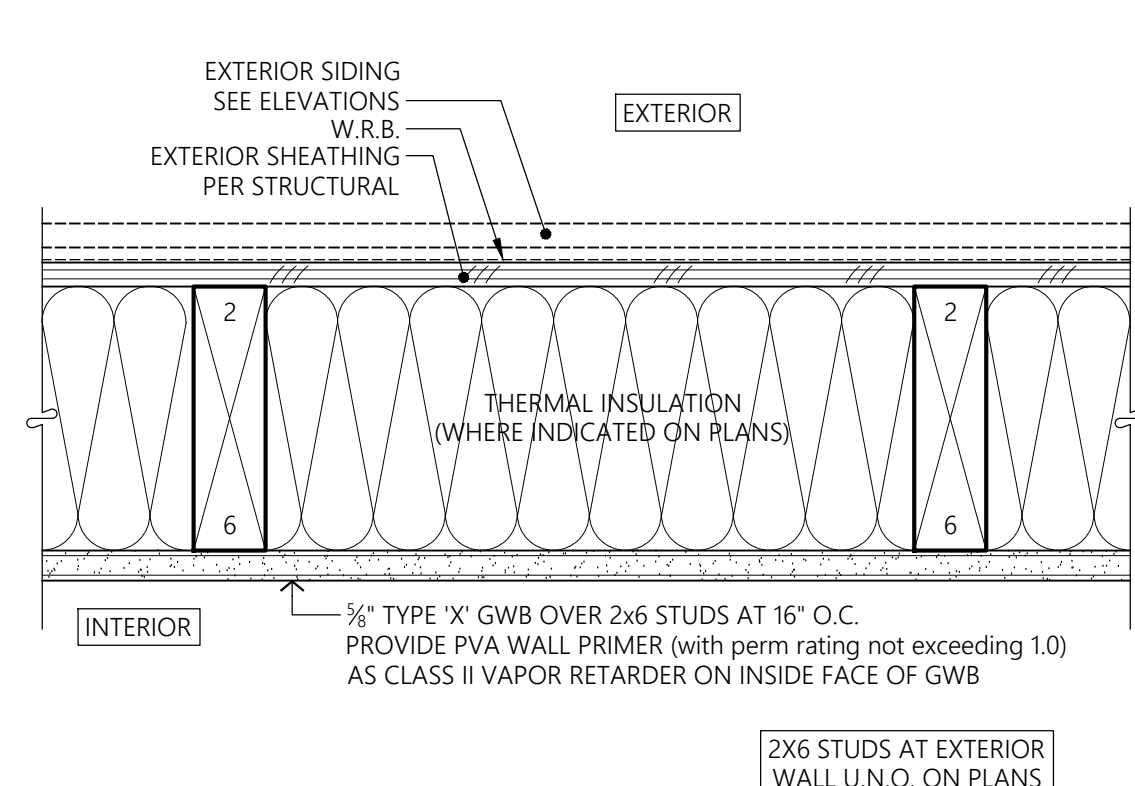

1 TYPICAL EXTERIOR WALL
 3\"/>


PLAN

NOTE: SHEAR DIAPHRAGM MAY OCCUR ON EITHER SIDE OF THE WALL OR ON BOTH SIDES.

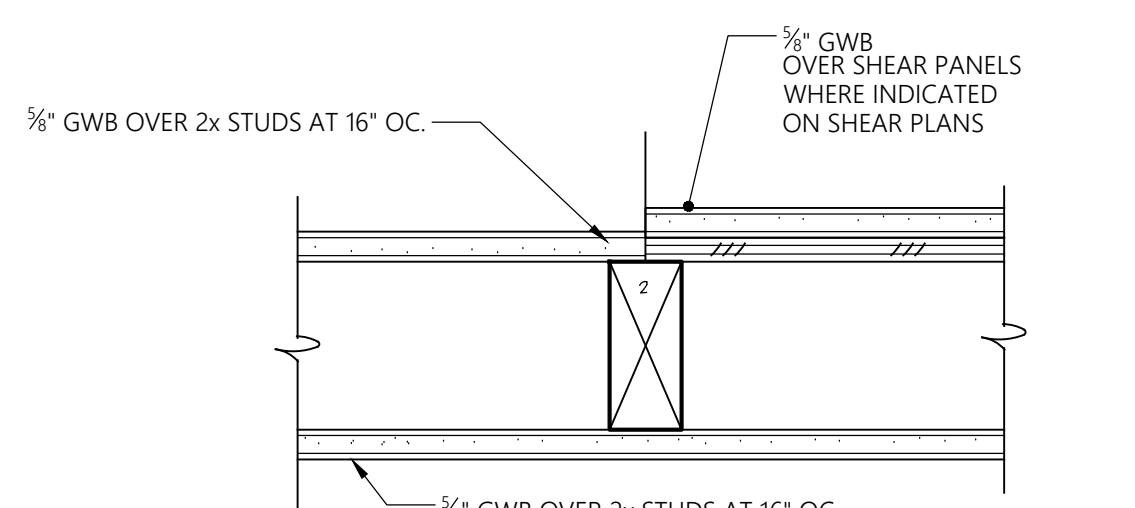

2 TYP. INTERIOR WALL
 3\"/>

PLAN

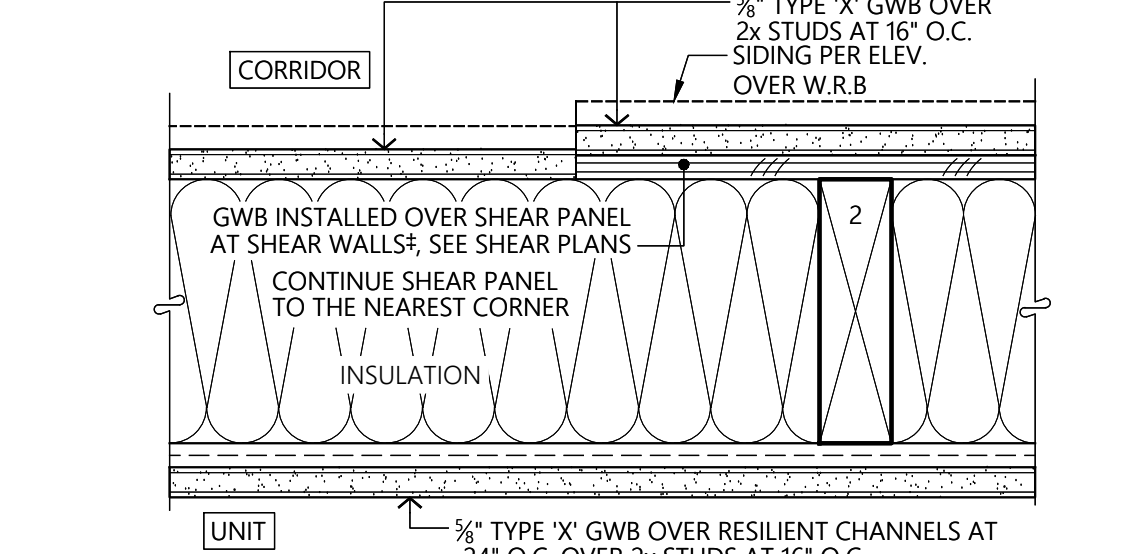


1-HR GA File No. WP3243 50-54 STC Sound

Resilient channels 24\"/>

3 TYP. 1-HR CORRIDOR WALL
 3\"/>

PLAN

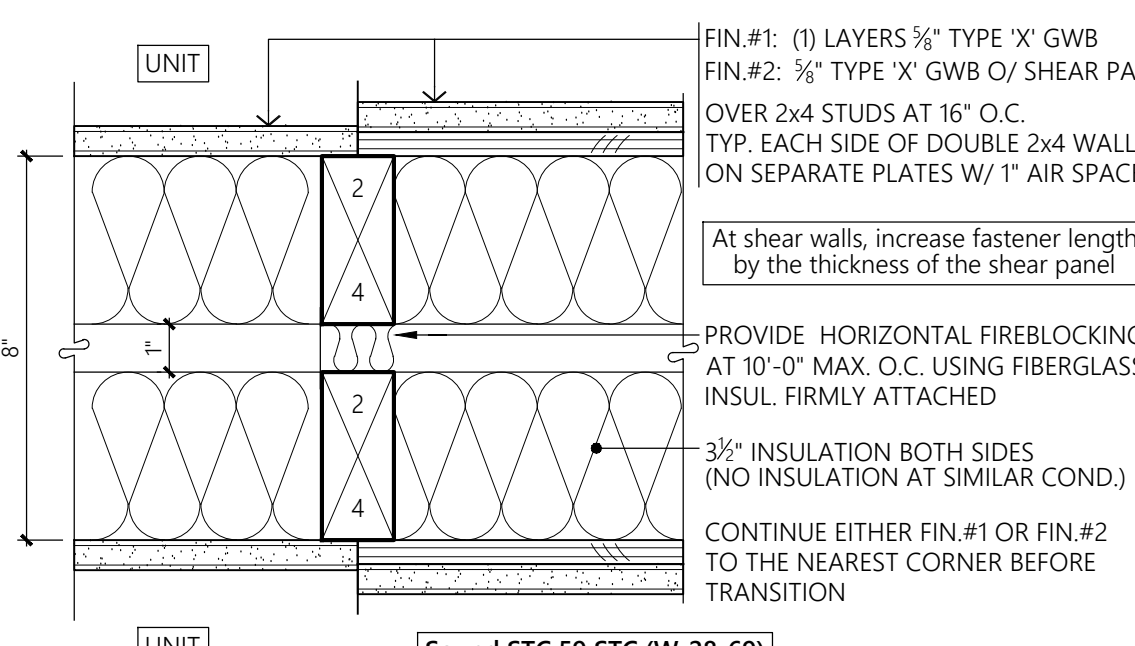


1-HR Using Calculated Fire Resistance Method
 Using IBC Section 722, Tables 722.6.2(1) and 722.6.2(2), 1/2\"/>

4 TYP. 1-HR COMMON WALL SEPARATING DWELLING UNITS
 3\"/>

PLAN

25 Central Way, Suite 210 Kirkland, Washington 98033 P: 425.454.7130 F: 425.658.1208 Web: www.milbrandtarch.com

Copyright 2023 Milbrandt Architects, INC., P.S. All rights reserved


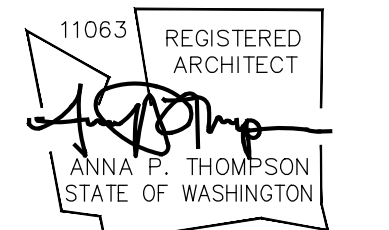


Bradley Heights Apartments
 Puyallup, Wa



Timberlane Partners

Revisions
 No. Date Description

Initial Publish Date:
 Date Plotted: **2-20-24**
 Job No.: **23-06** Drawn By: **APT/HDM**
 Sheet No.:

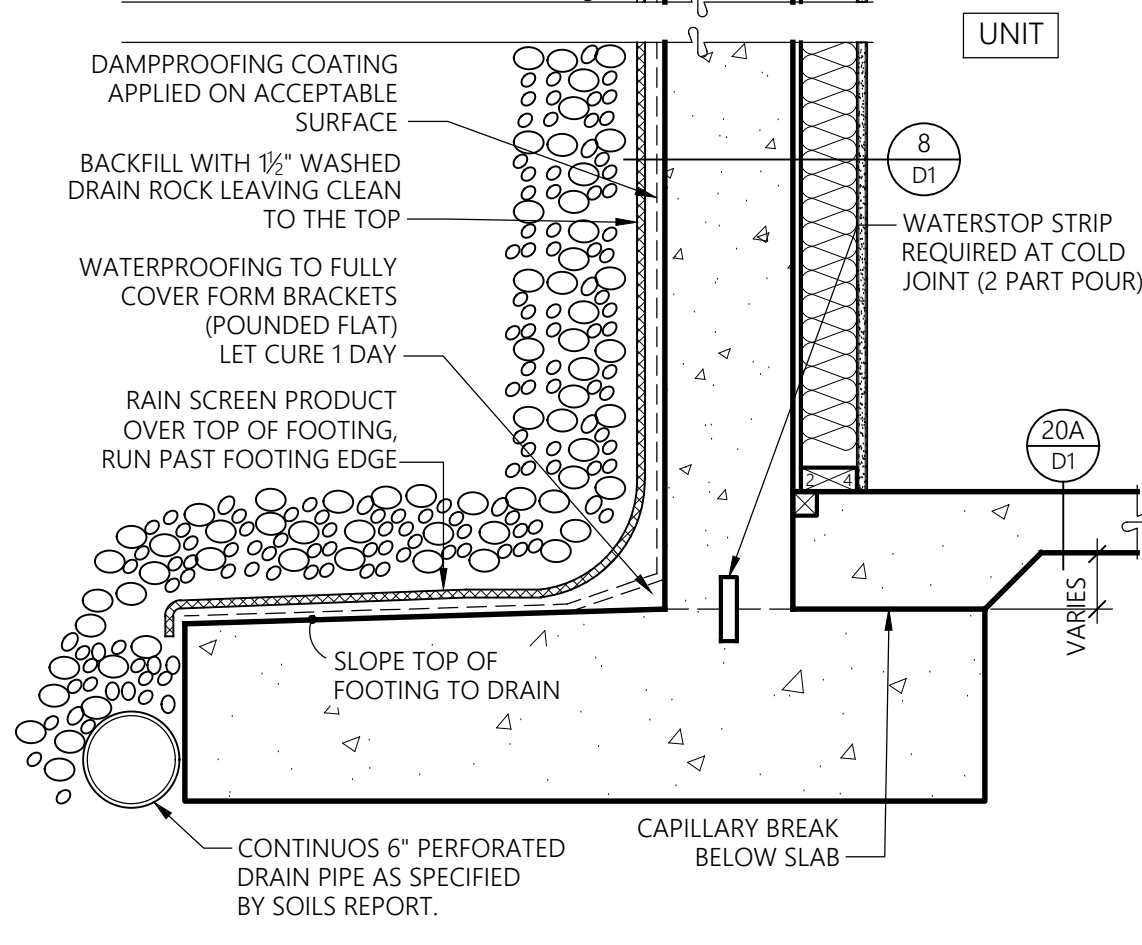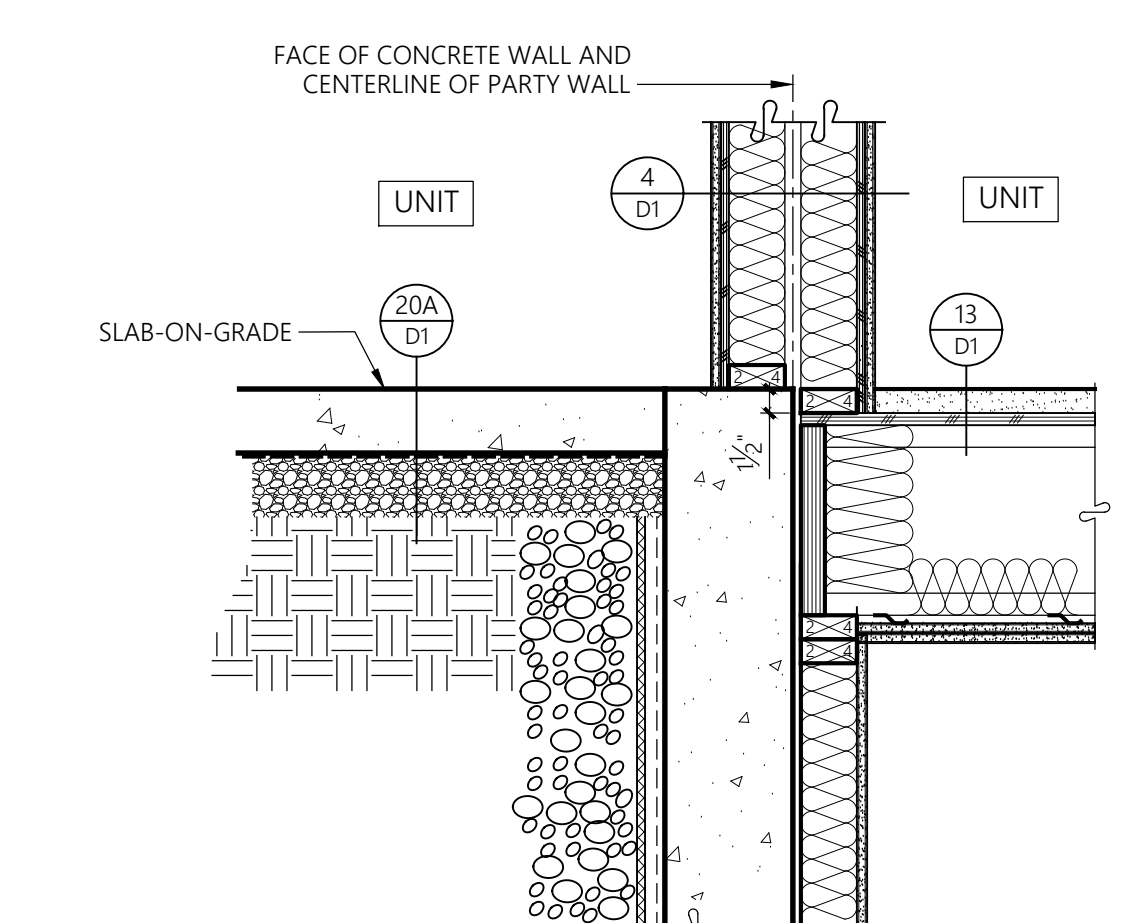


18 BASEMENT RETAINING WALL
1" = 1'-0" SECTION

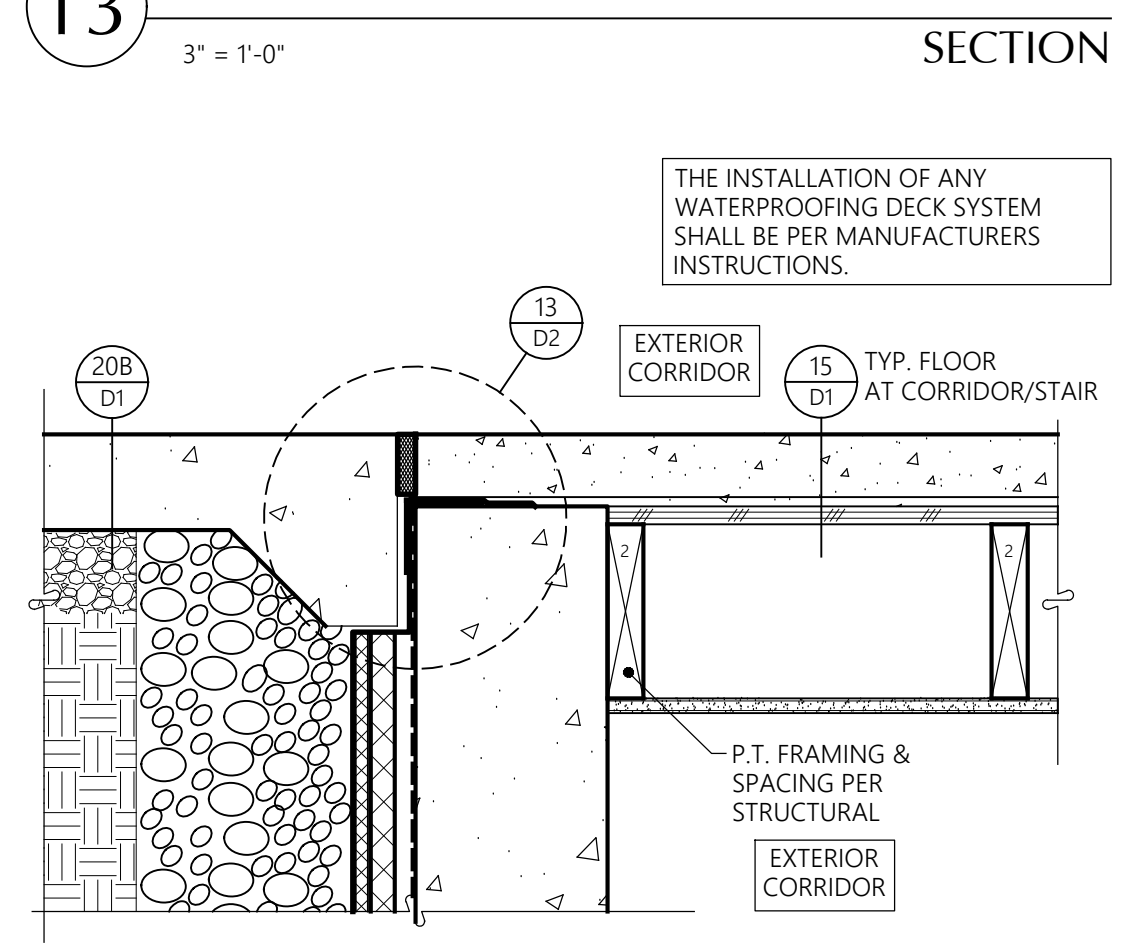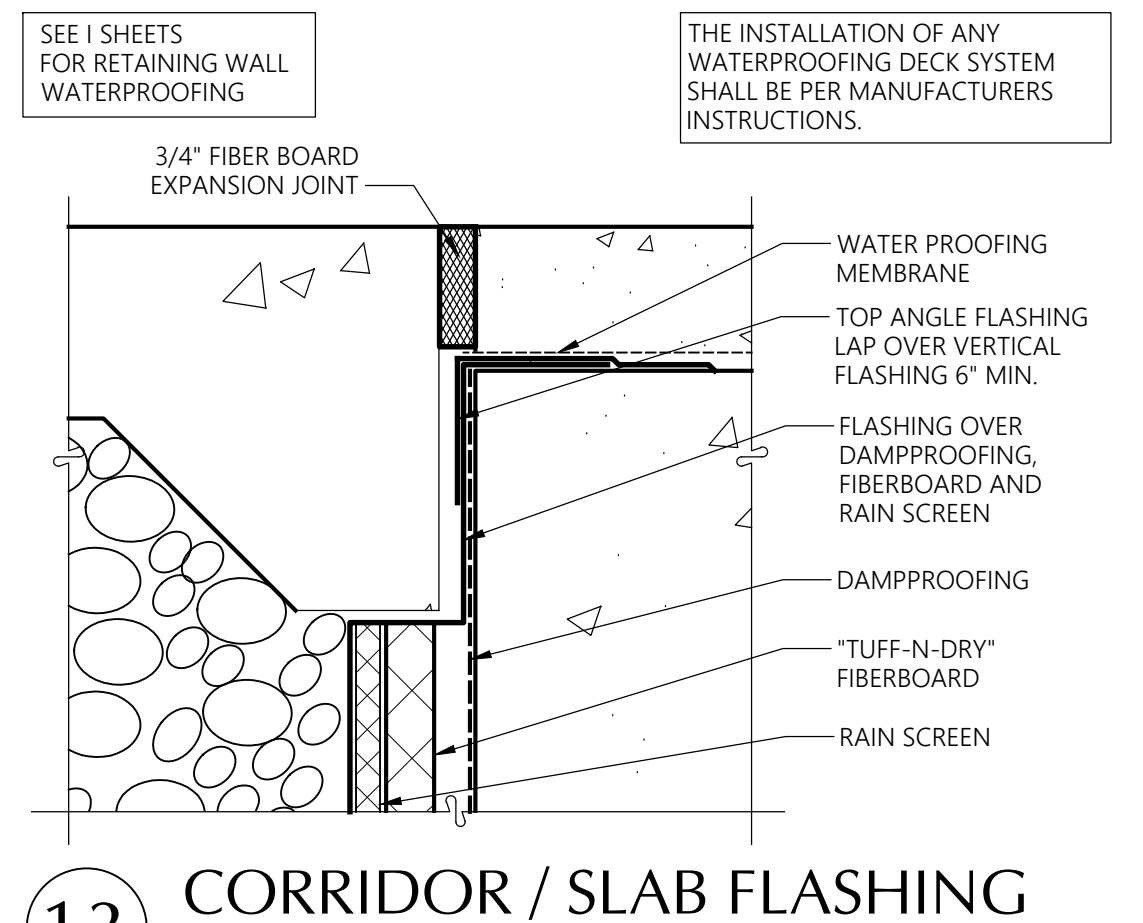


14 CORRIDOR / SLAB TRANSITION
1-1/2" = 1'-0" SECTION


SEE STRUCTURAL ENGINEERS DESIGN FOR RETAINING WALL CONSTRUCTION PAGE S3.1

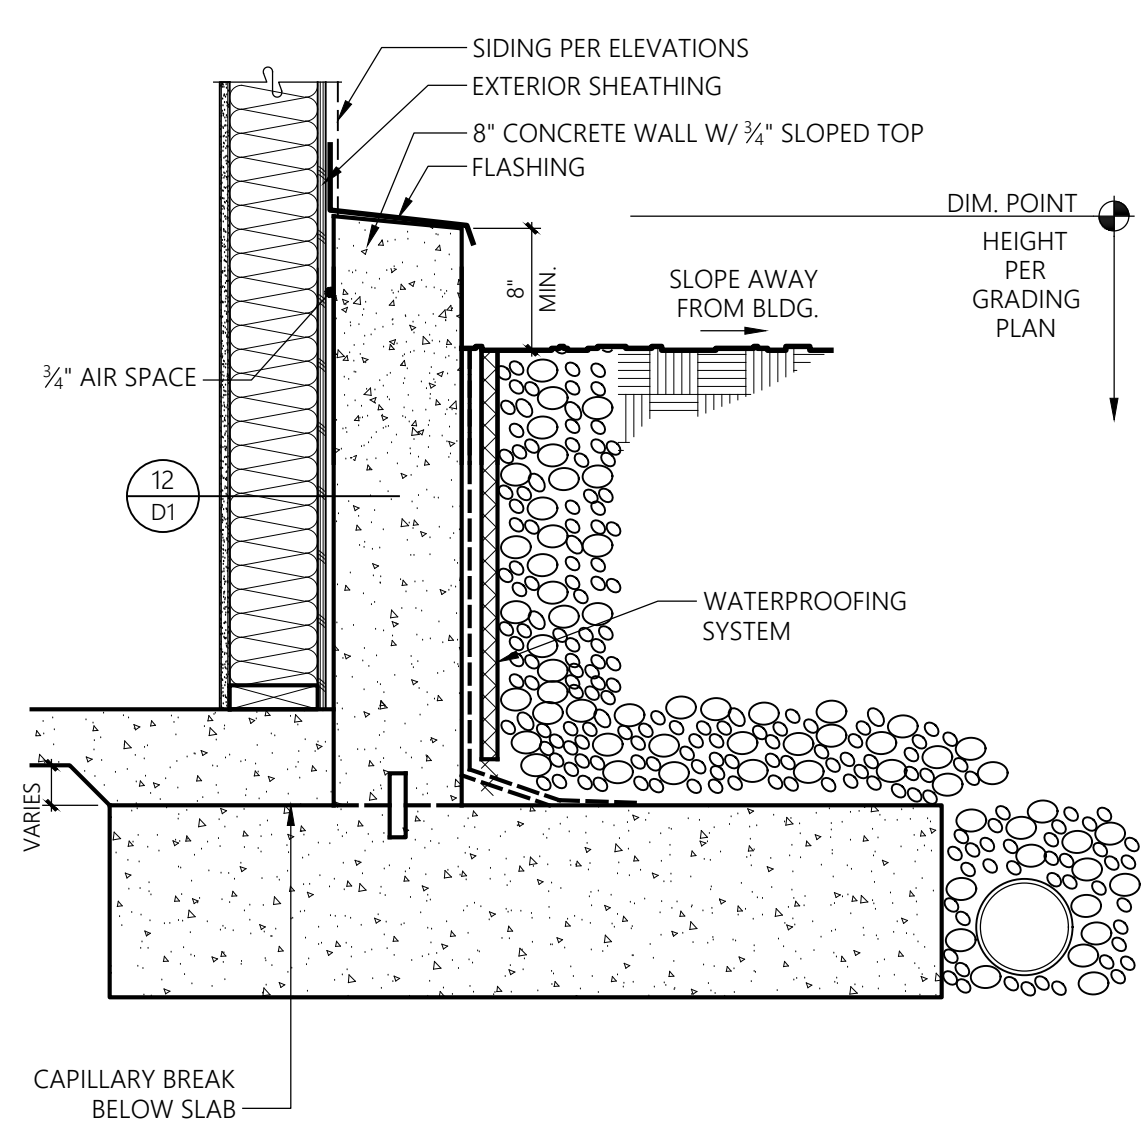


20 CONCRETE WALL
1" = 1'-0" SECTION

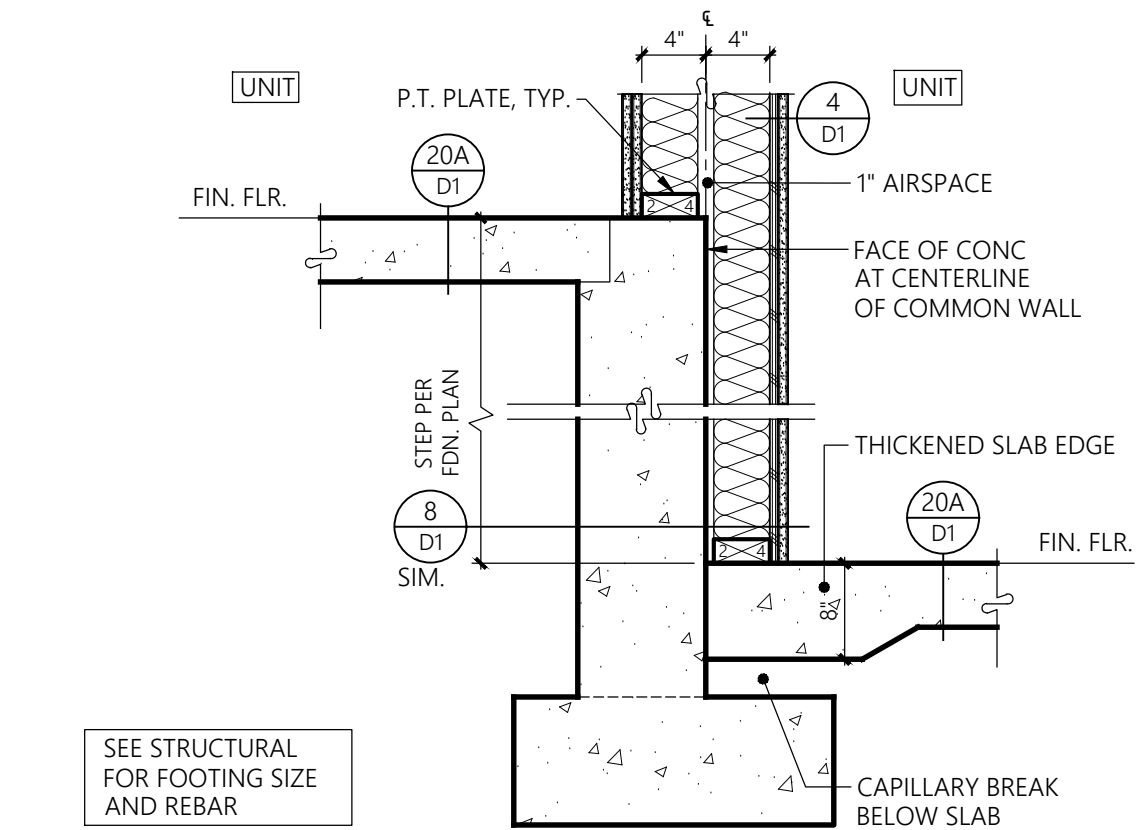


16 COMMON WALL FOUNDATION UNIT -T0- UNIT AT STEP
1" = 1'-0" SECTION

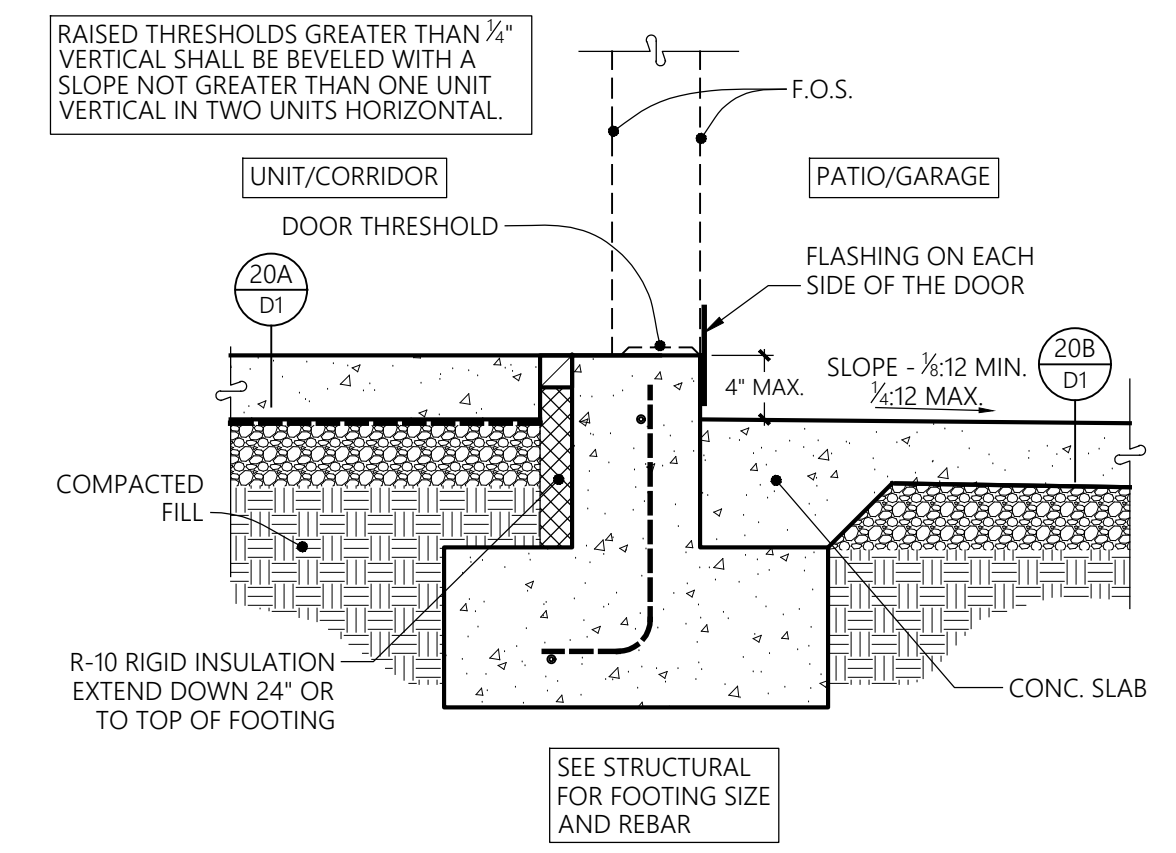


5 SWING DOOR THRESHOLD AT PATIO OR GARAGE
1" = 1'-0" SECTION

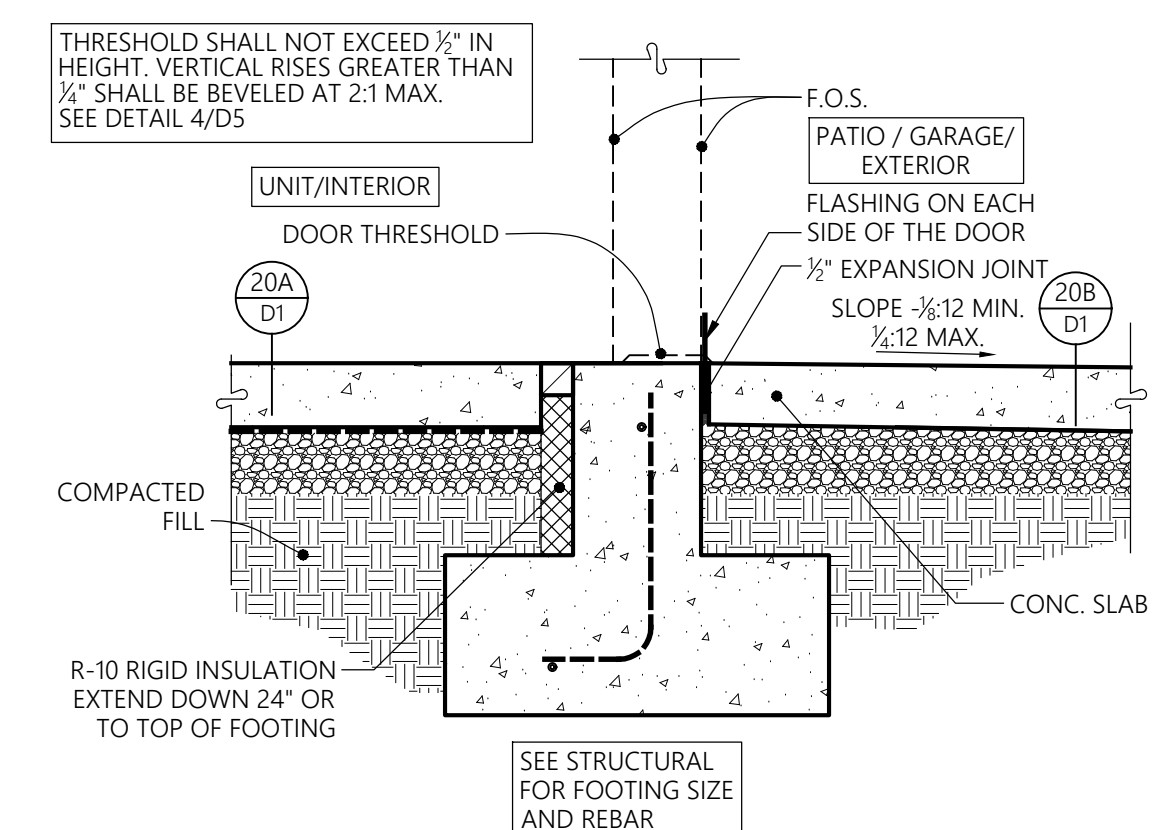


6 SWING DOOR THRESHOLD AT ACCESSIBLE ENTRANCE
1" = 1'-0" SECTION

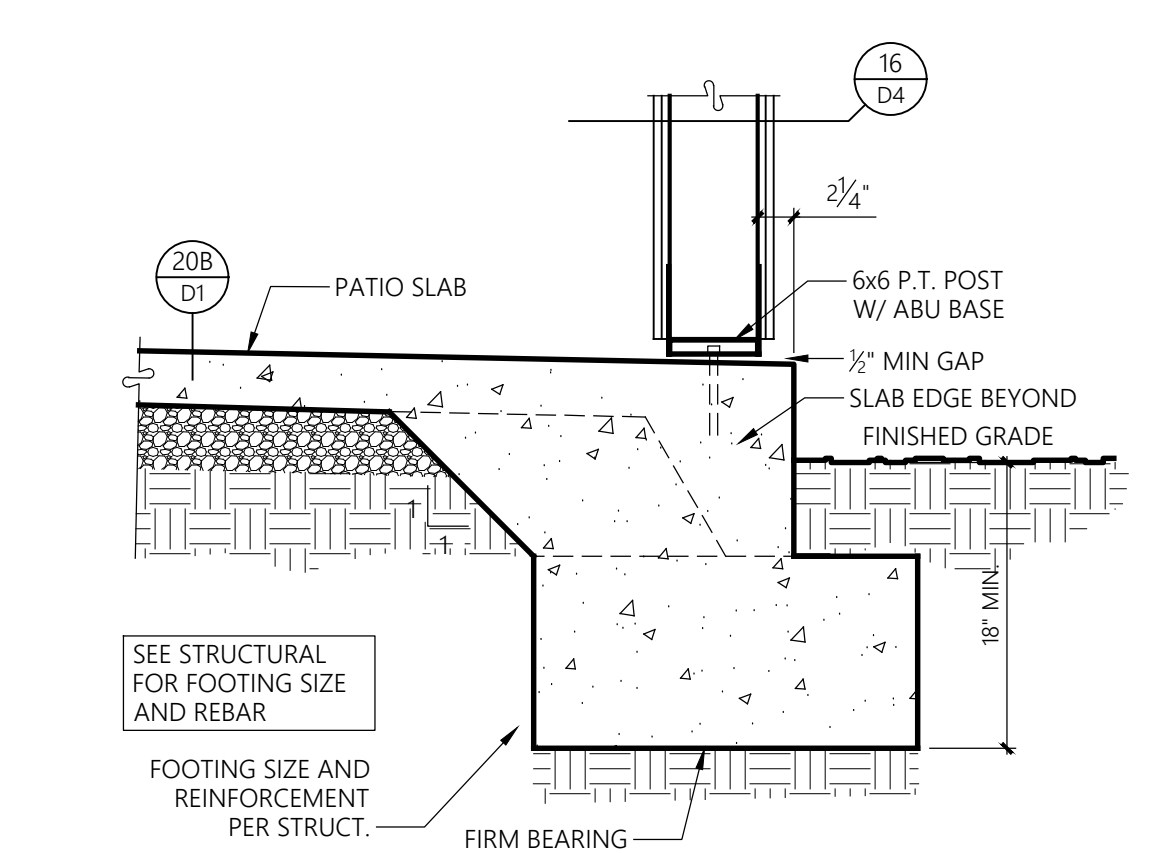


7 POST FOOTING AT PATIO
1" = 1'-0" SECTION

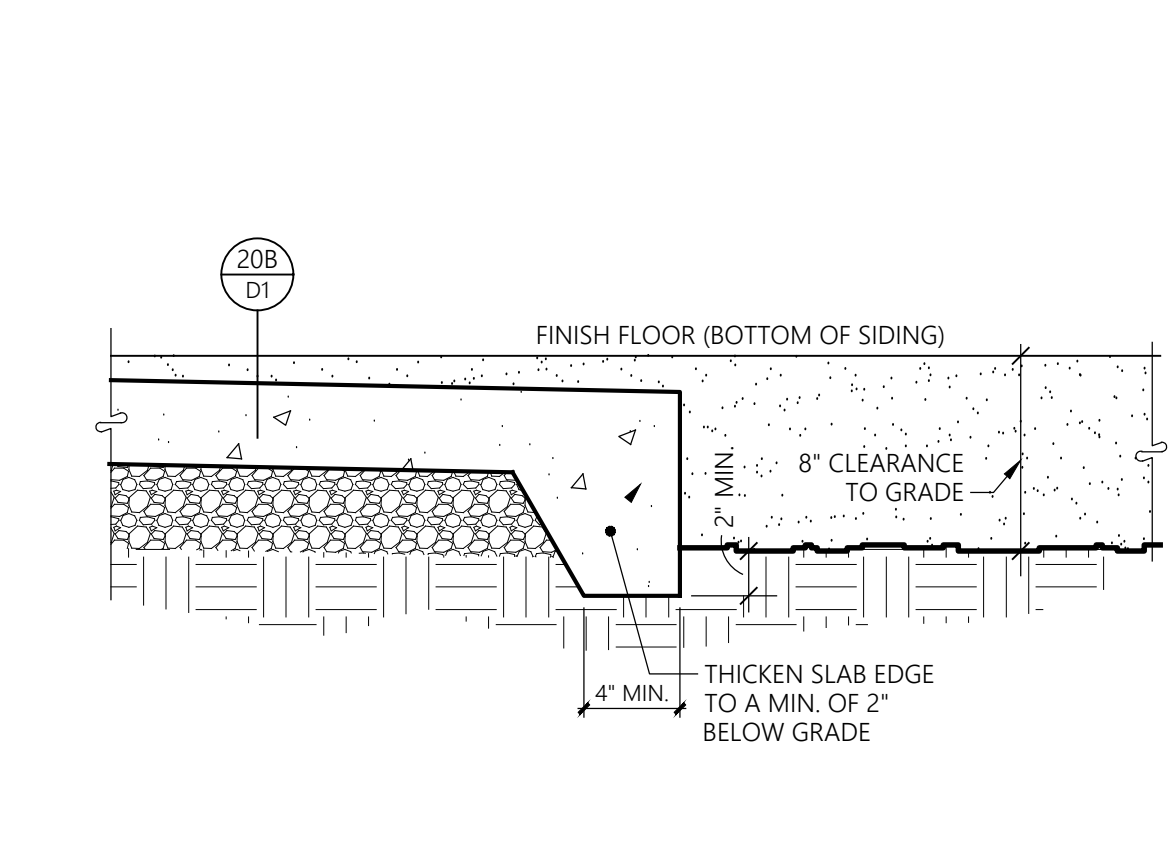


8 THICKENED CONC. SLAB EDGE AT PORCH / PATIO
1-1/2" = 1'-0" SECTION

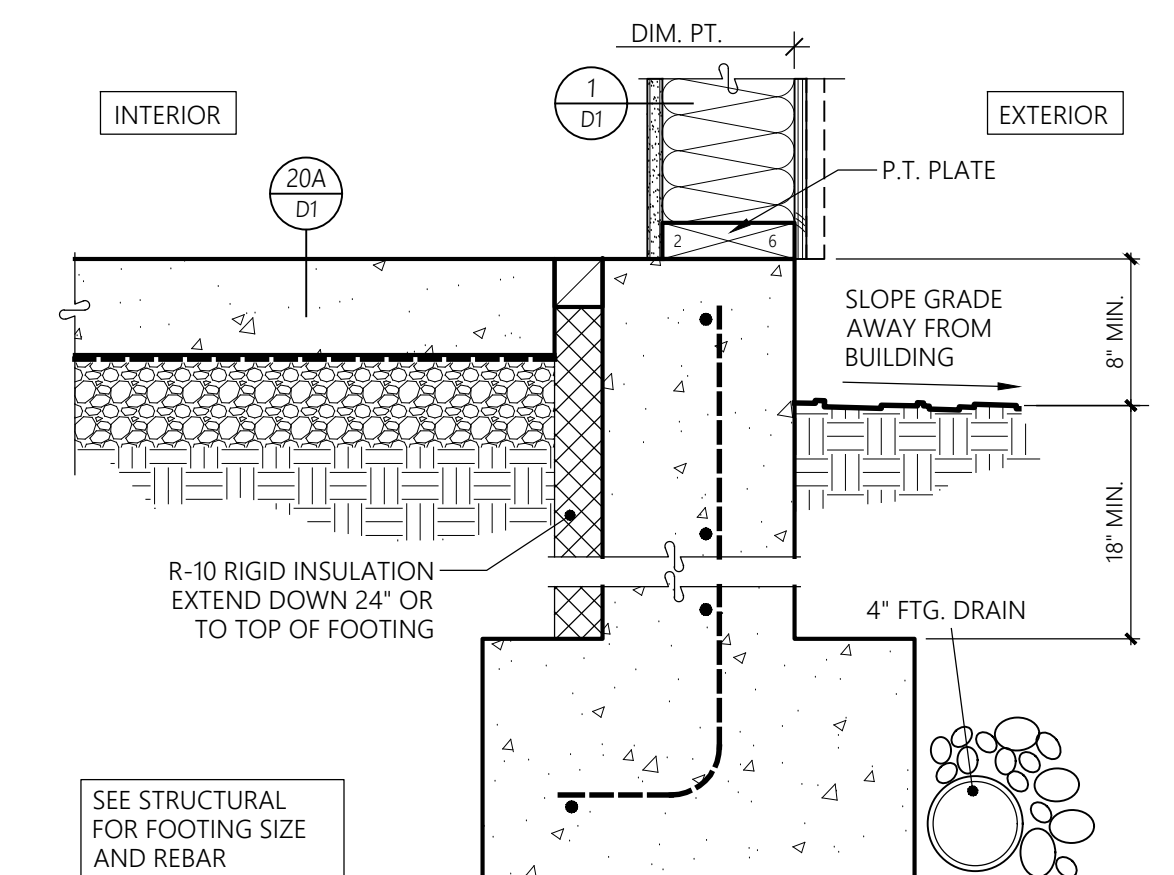


1 TYP. EXTERIOR WALL FOOTING
1-1/2" = 1'-0" SECTION

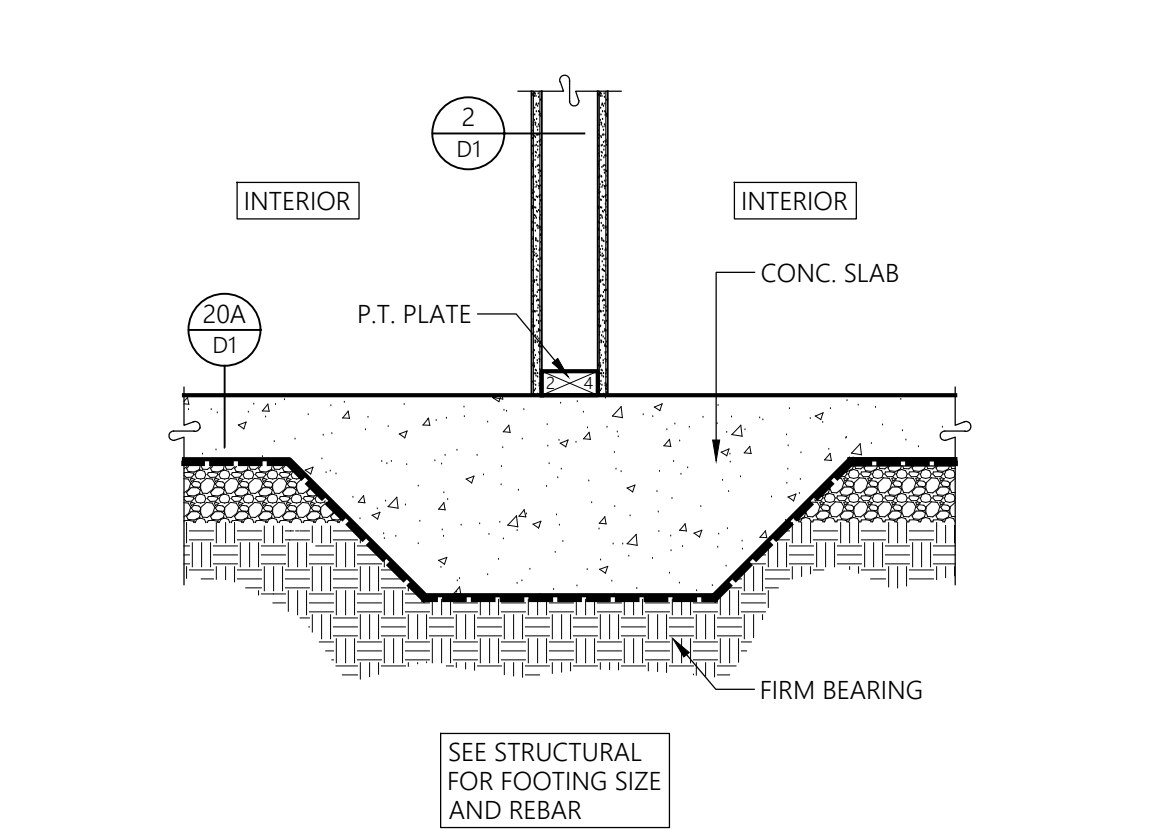



2 INTERIOR WALL FOOTING
1" = 1'-0" SECTION

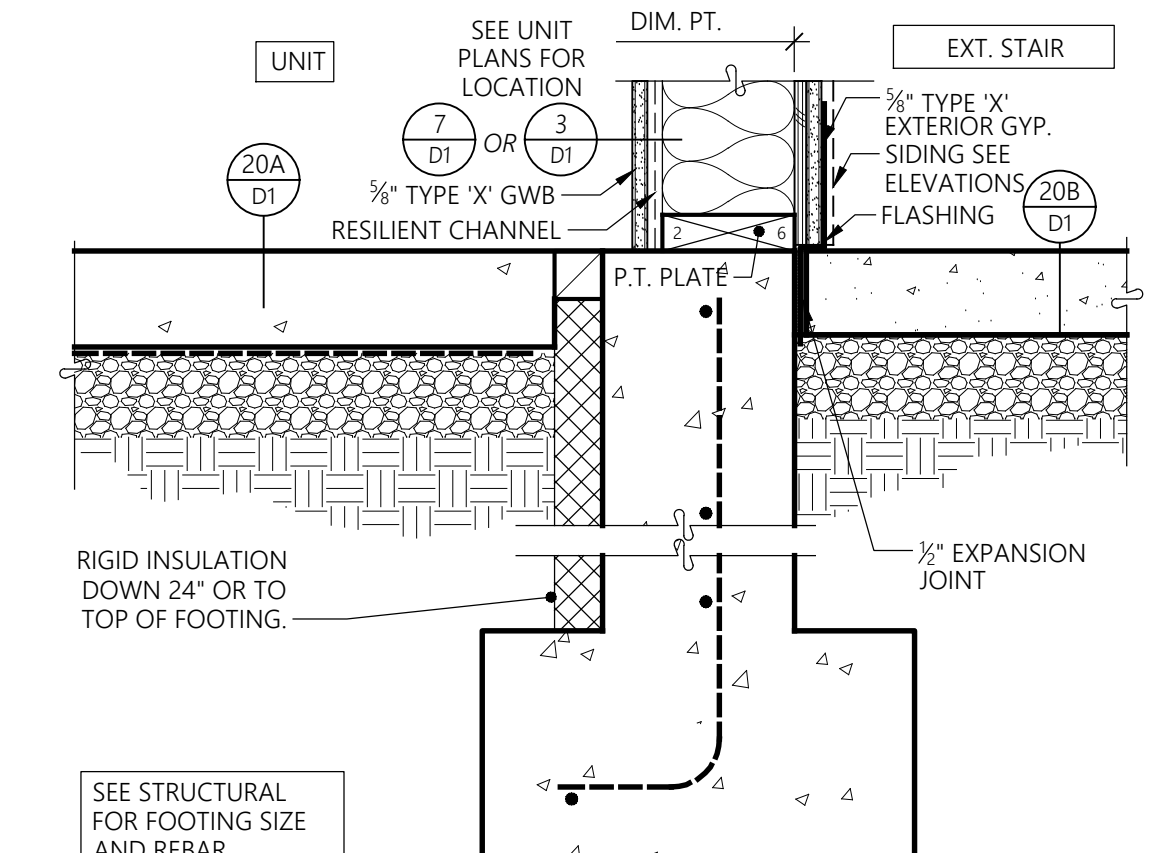


3 TYP. STAIR WALL FOOTING
1 1/2" = 1'-0" SECTION

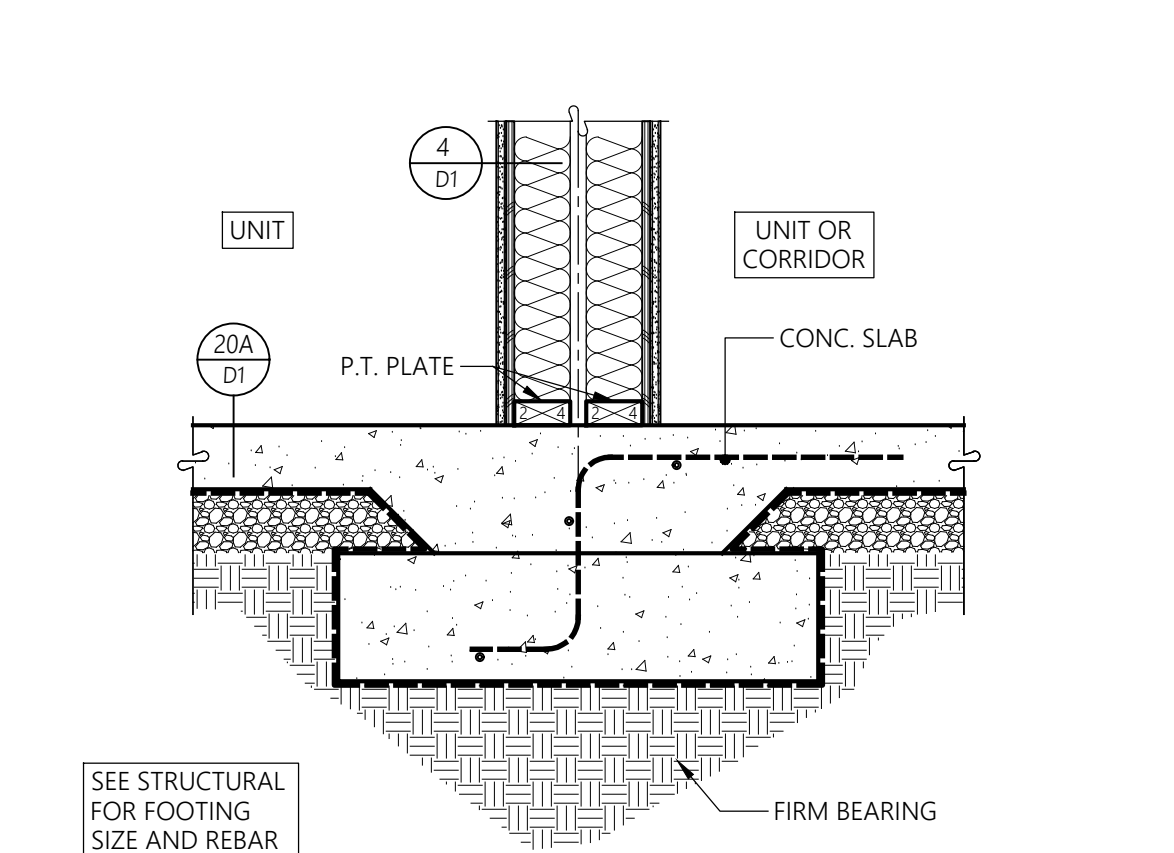


4 COMMON WALL FOUNDATION
1" = 1'-0" SECTION

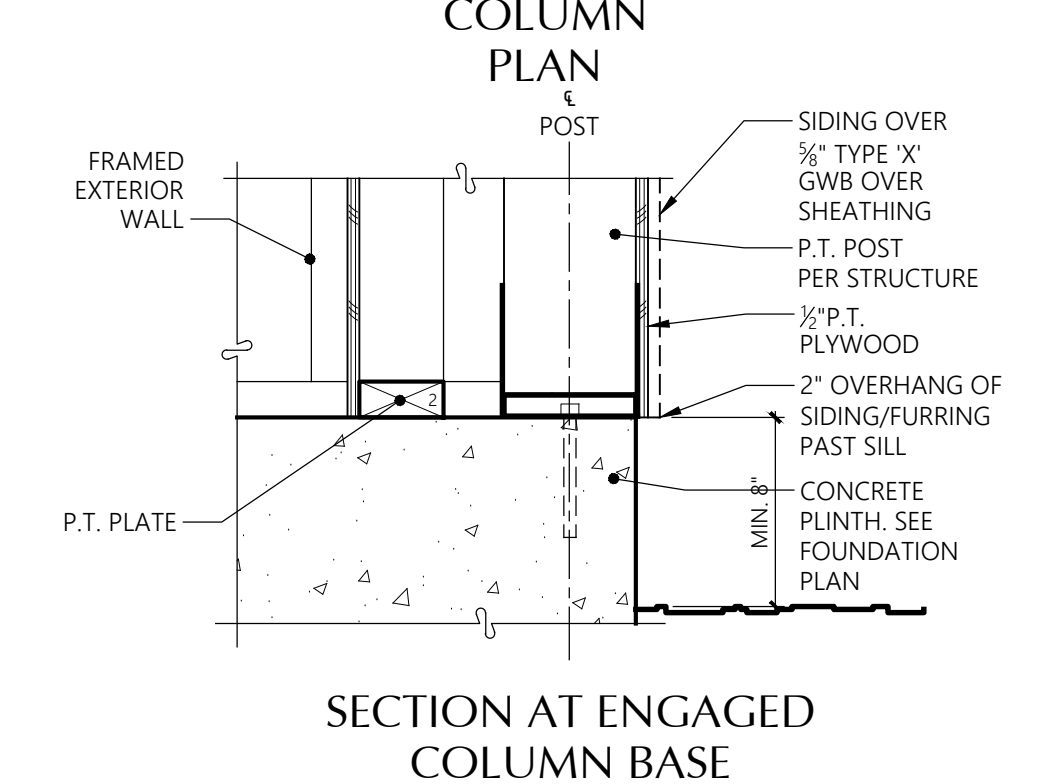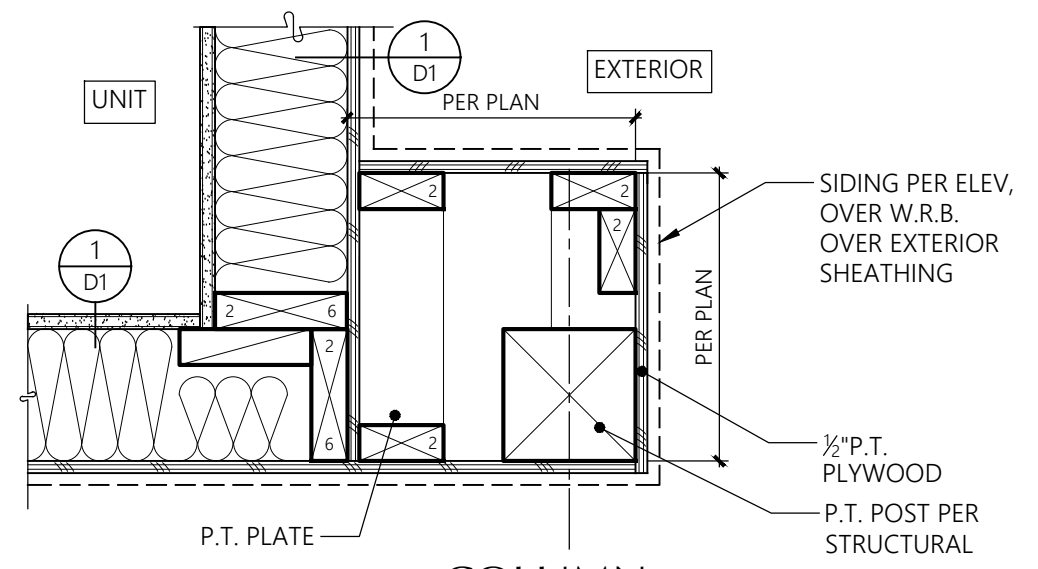



17 FURRED COLUMN
1-1/2" = 1'-0"

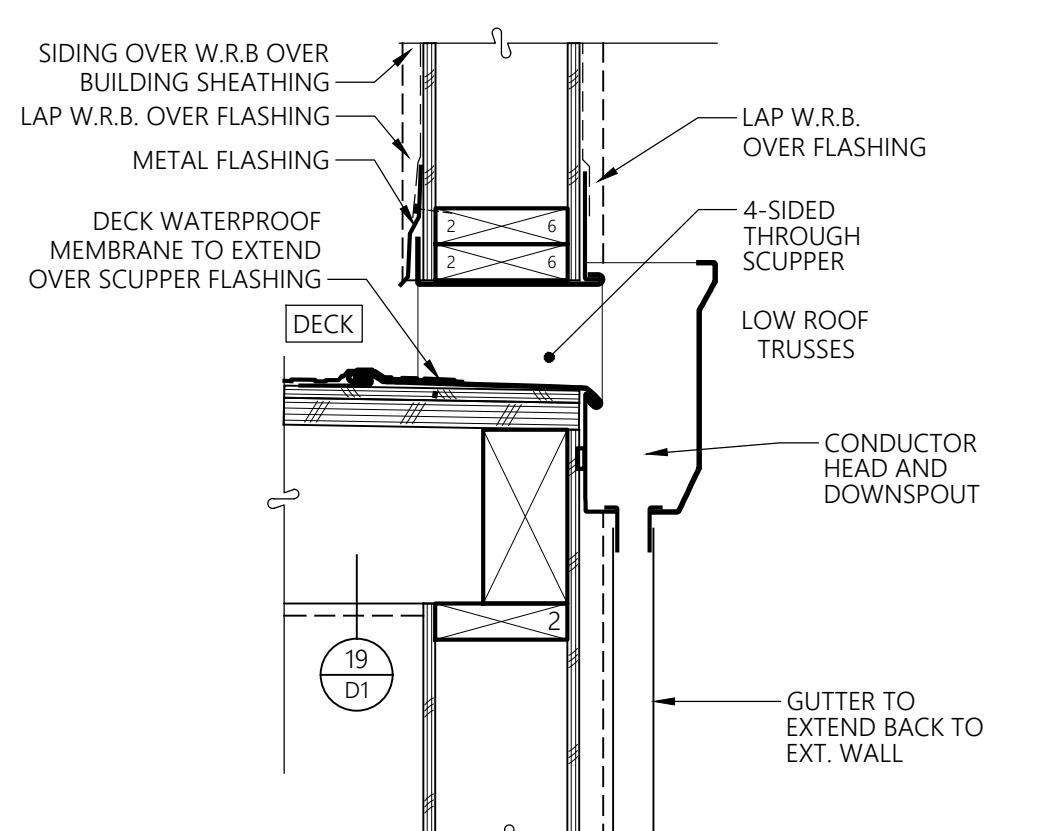


18 SCUPPER AT DECK
1-1/2" = 1'-0"

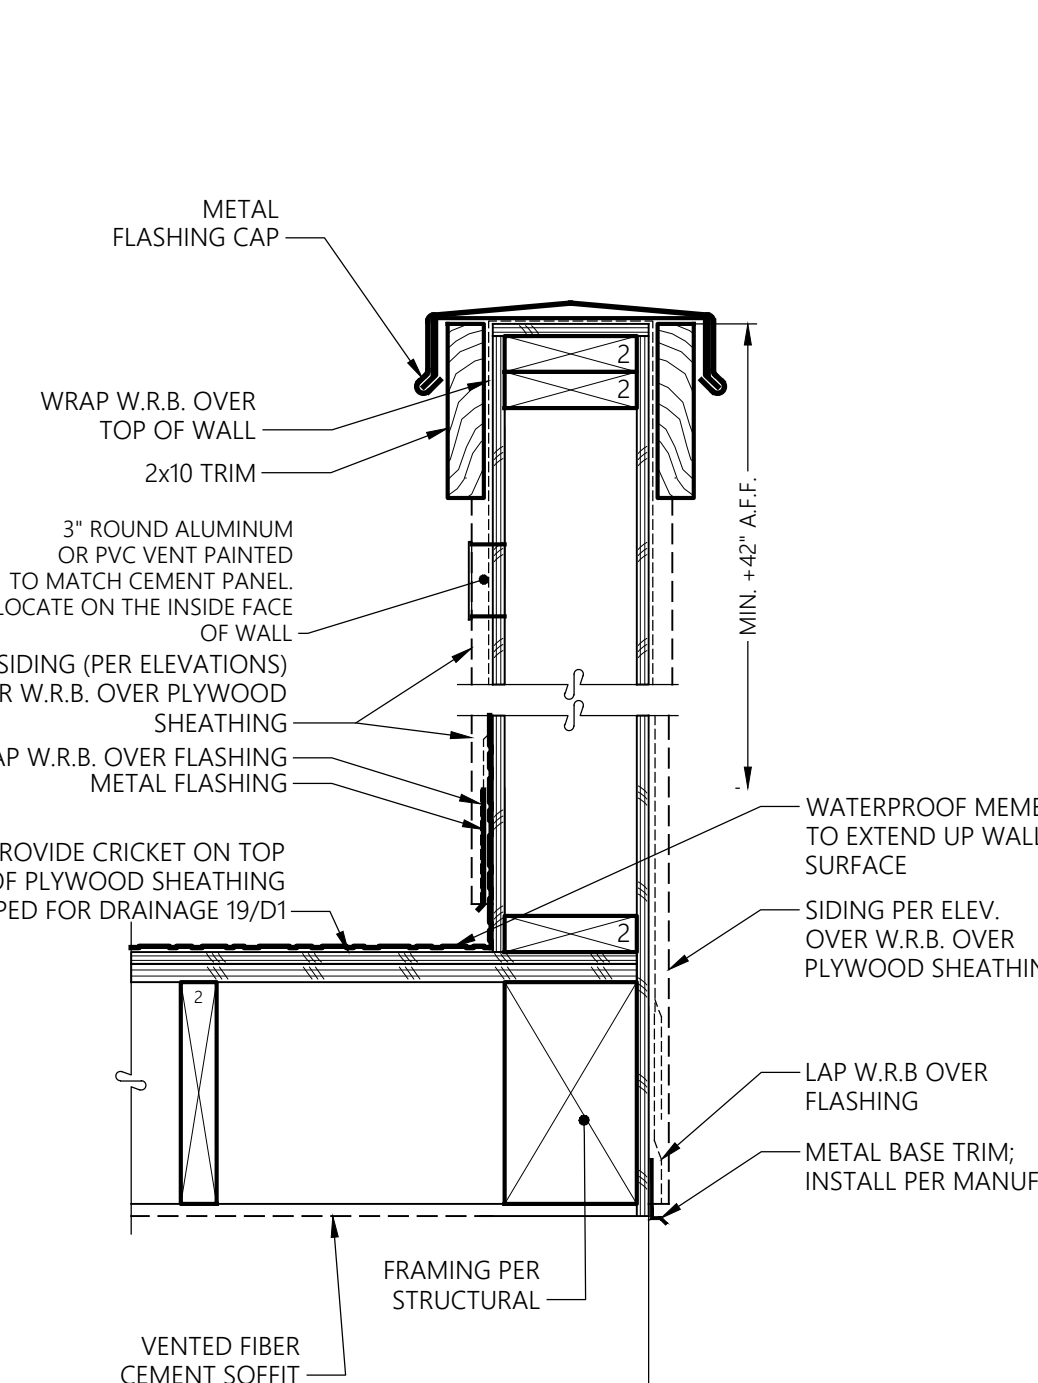


20 LOW WALL @ DECK EDGE
1-1/2" = 1'-0"

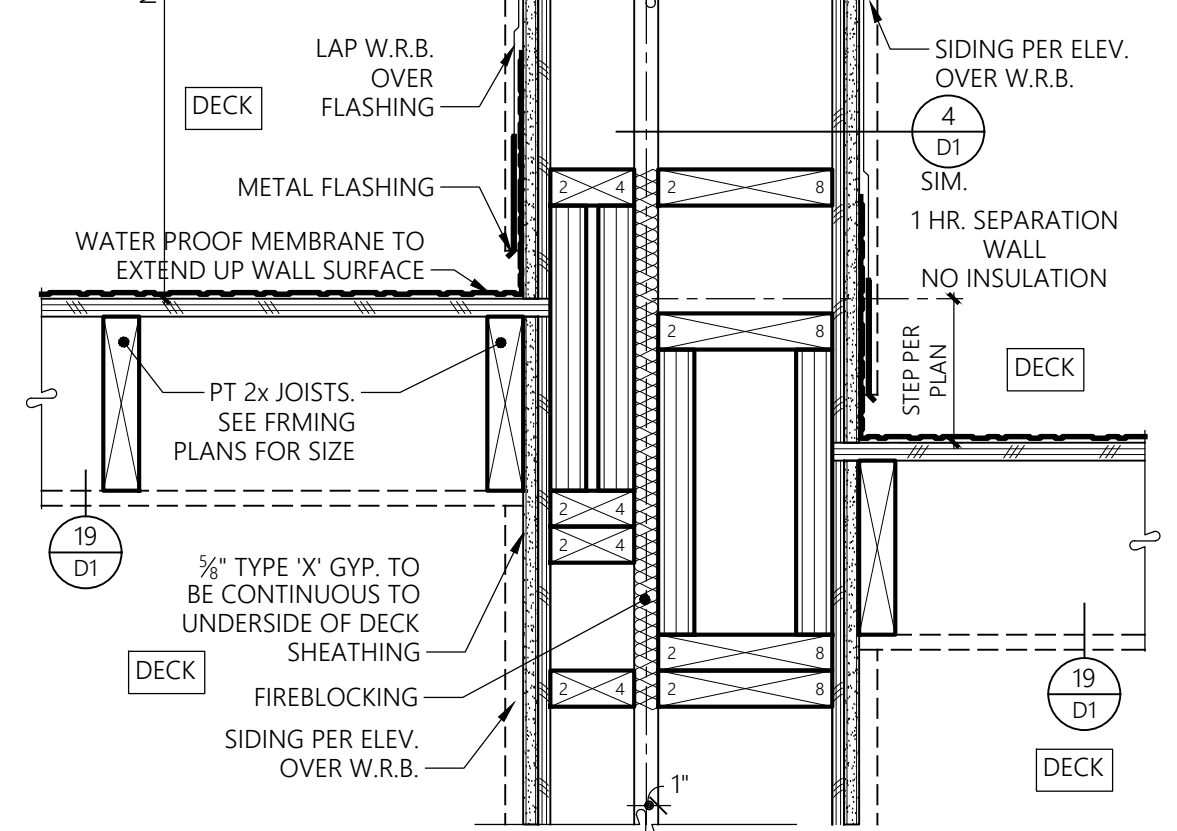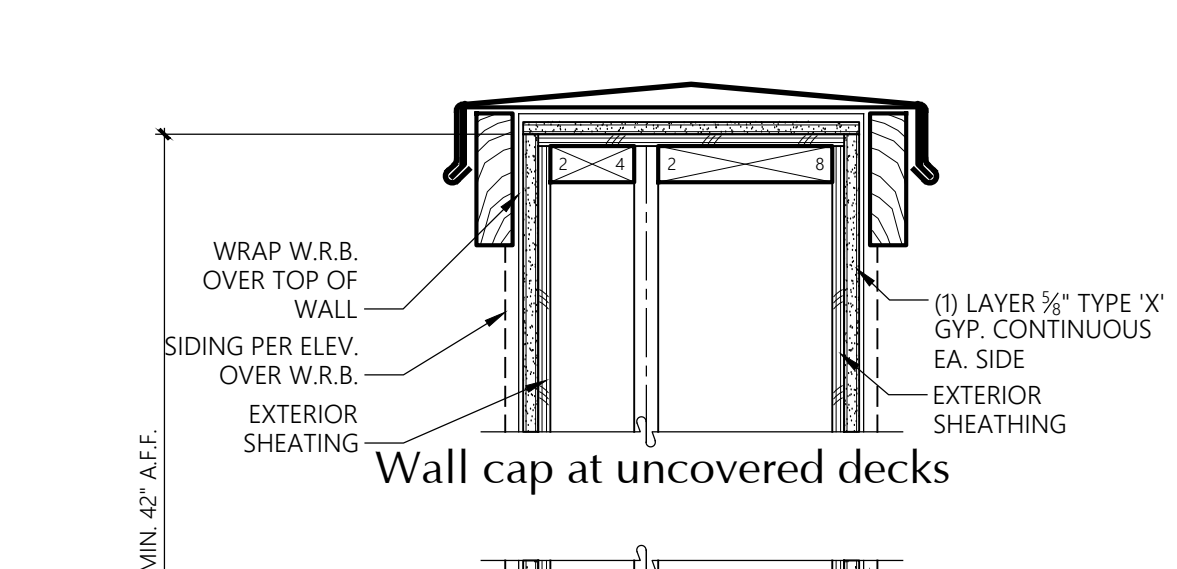


9 ATTIC ACCESS
1-1/2" = 1'-0"

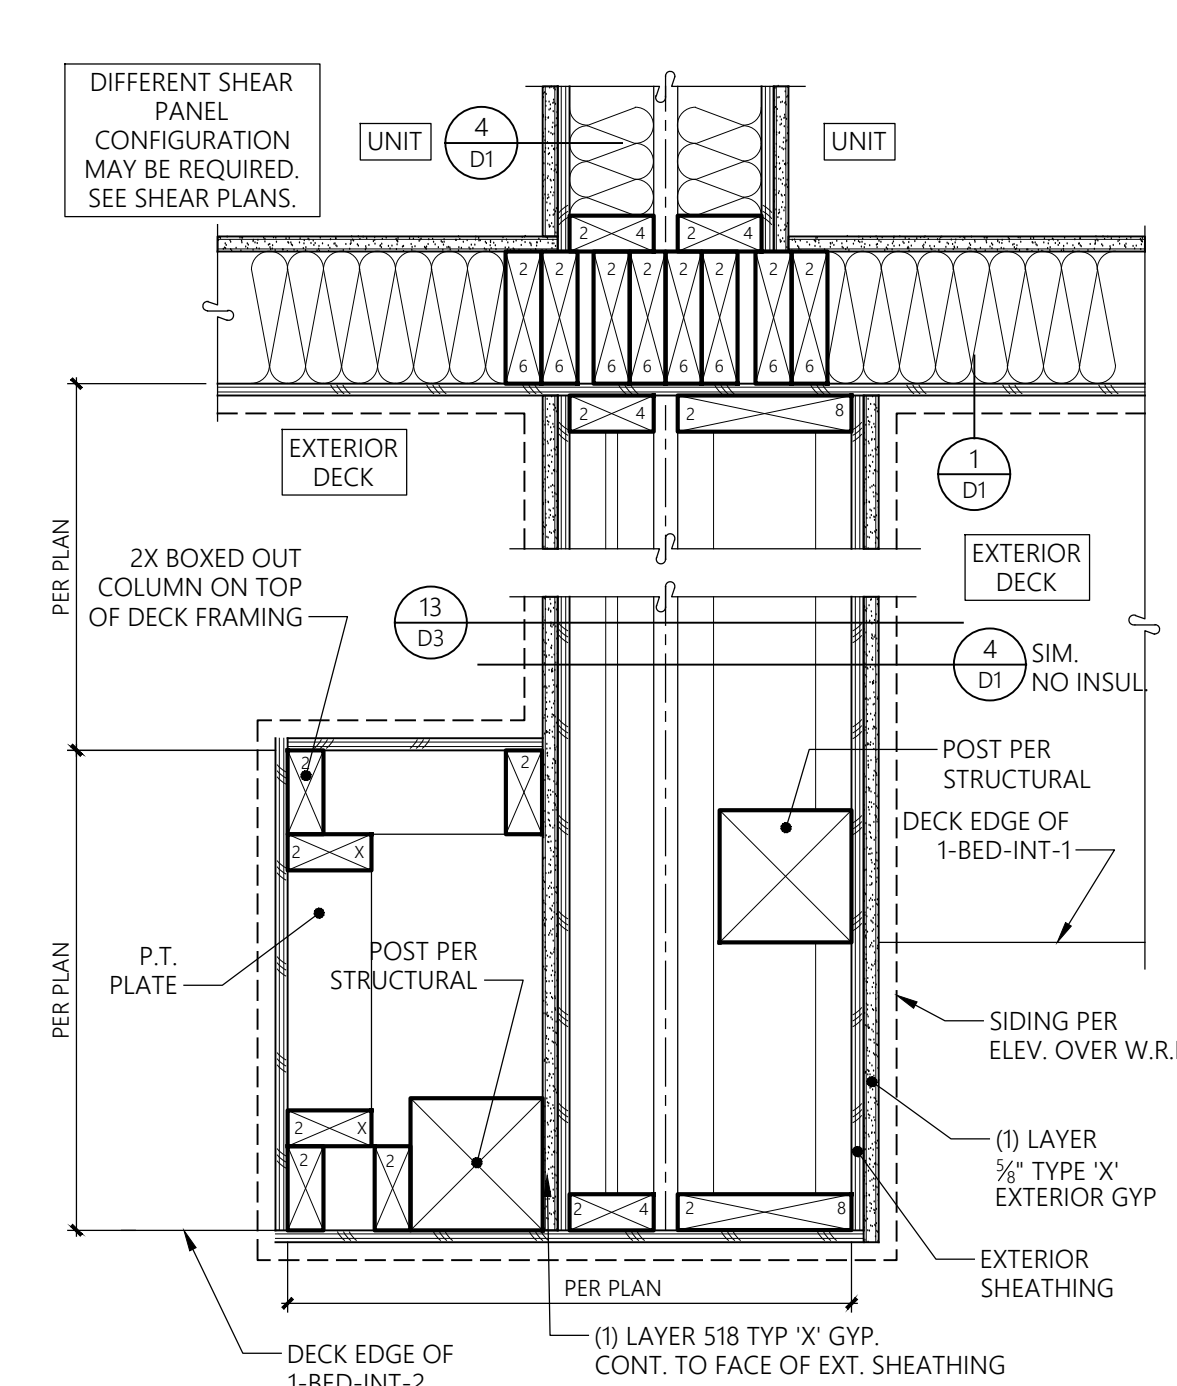


13 STEPPED COMMON WALL @ DECK
1-1/2" = 1'-0"




15 UNIT SEP. WALL AT DECK
1-1/2" = 1'-0"

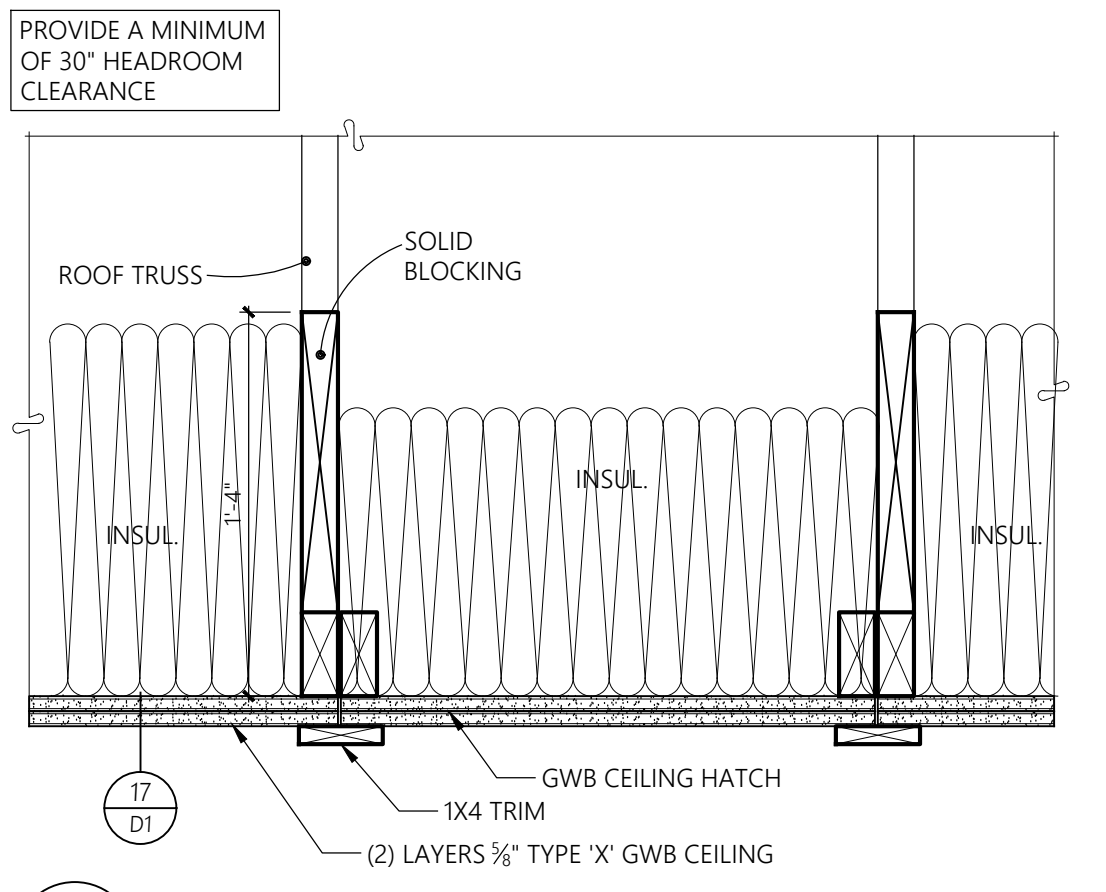


10 TUB/SHOWER AT 1-HR SEP. WALL
1" = 1'-0"

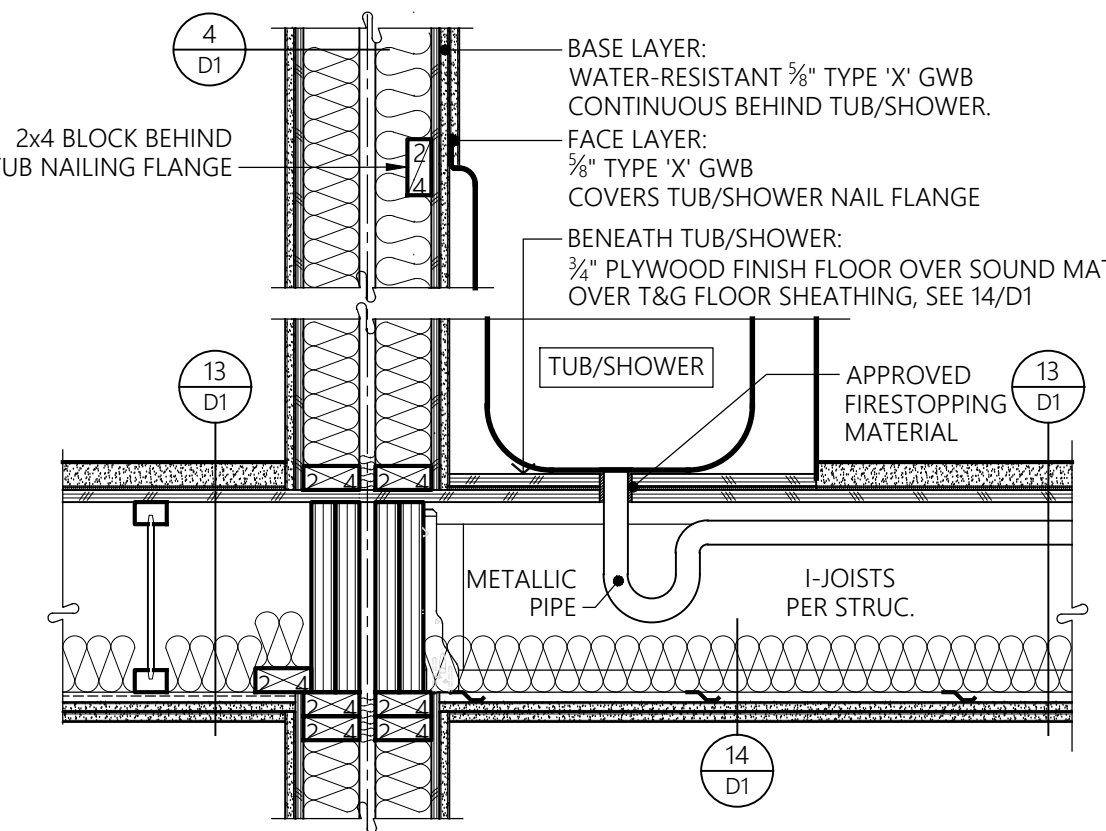


11 INTERIOR WALL AT UNIT SEP. WALL
1-1/2" = 1'-0"

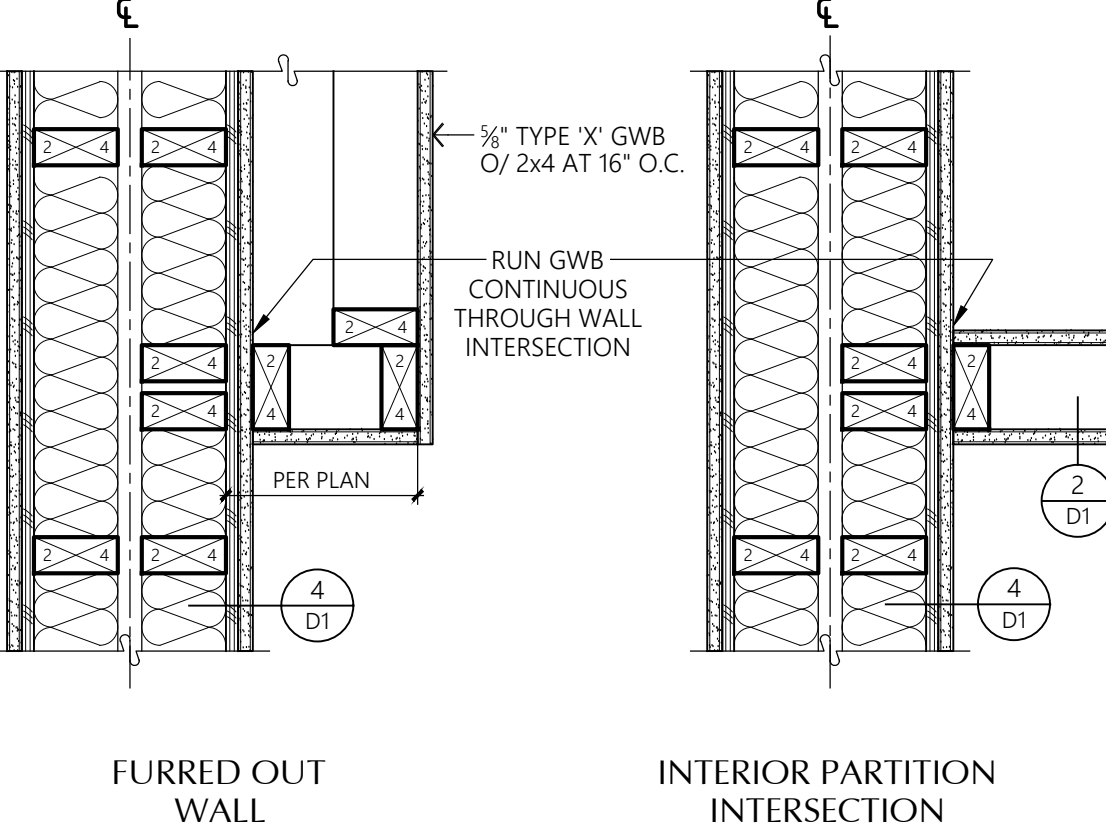


11 INTERIOR WALL AT UNIT SEP. WALL
1-1/2" = 1'-0"

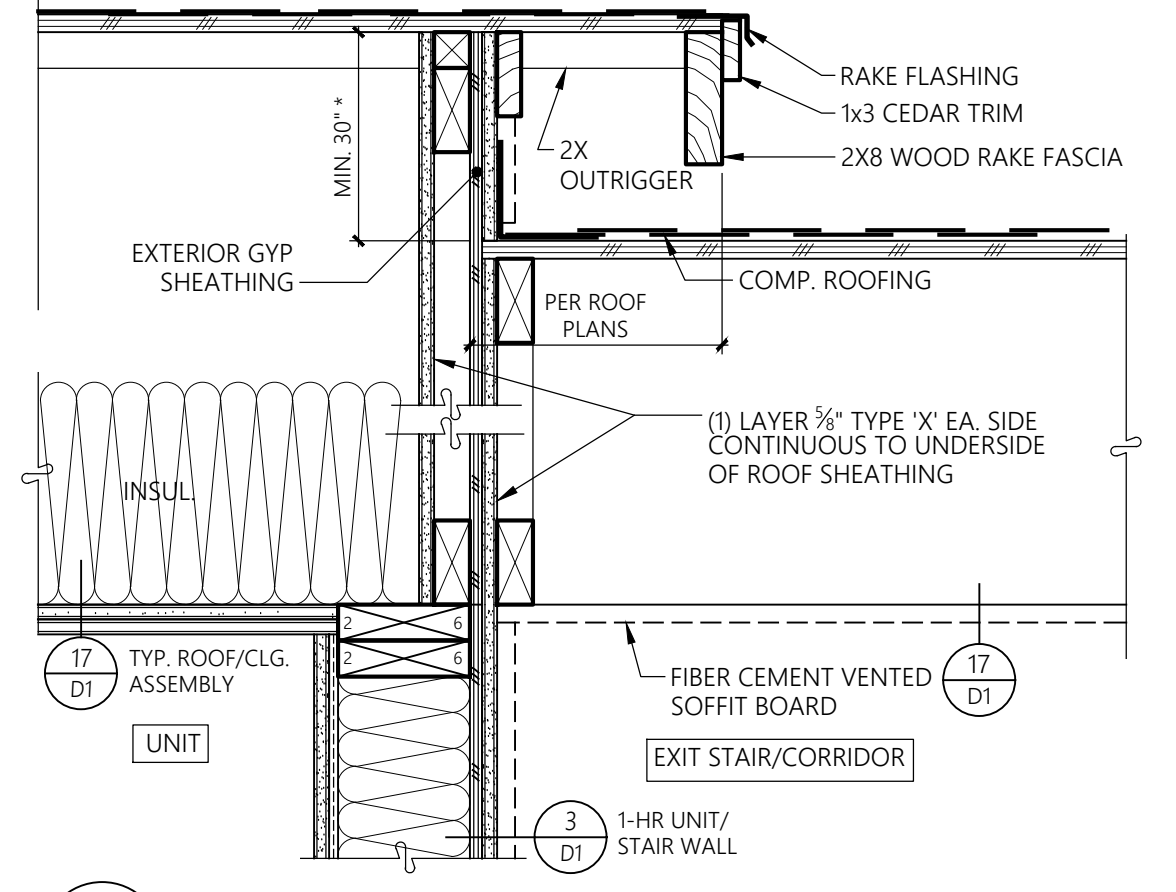


5 1-HR STAIR WALL AT ROOF
1-1/2" = 1'-0"

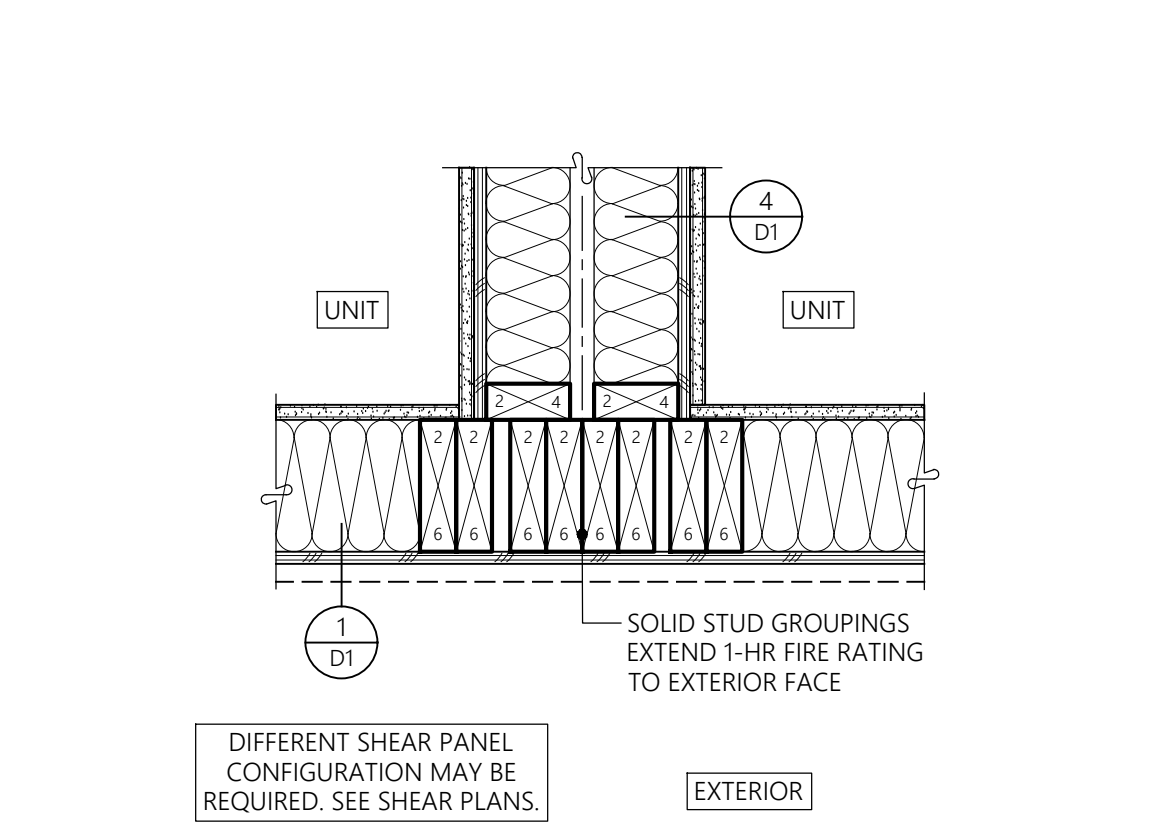


6 UNIT SEP. WALL AT EXT. WALL
1-1/2" = 1'-0"

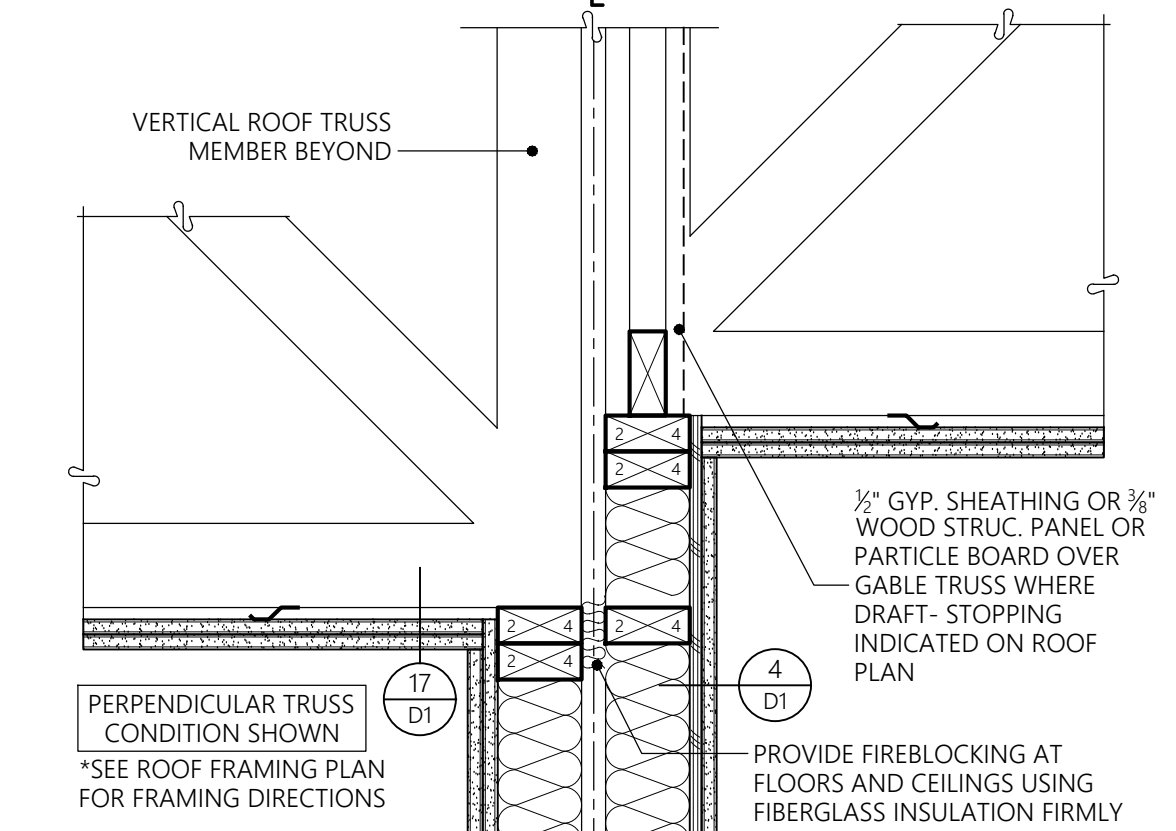


7 UNIT SEP. WALL AT STEPPED ROOF
1-1/2" = 1'-0"

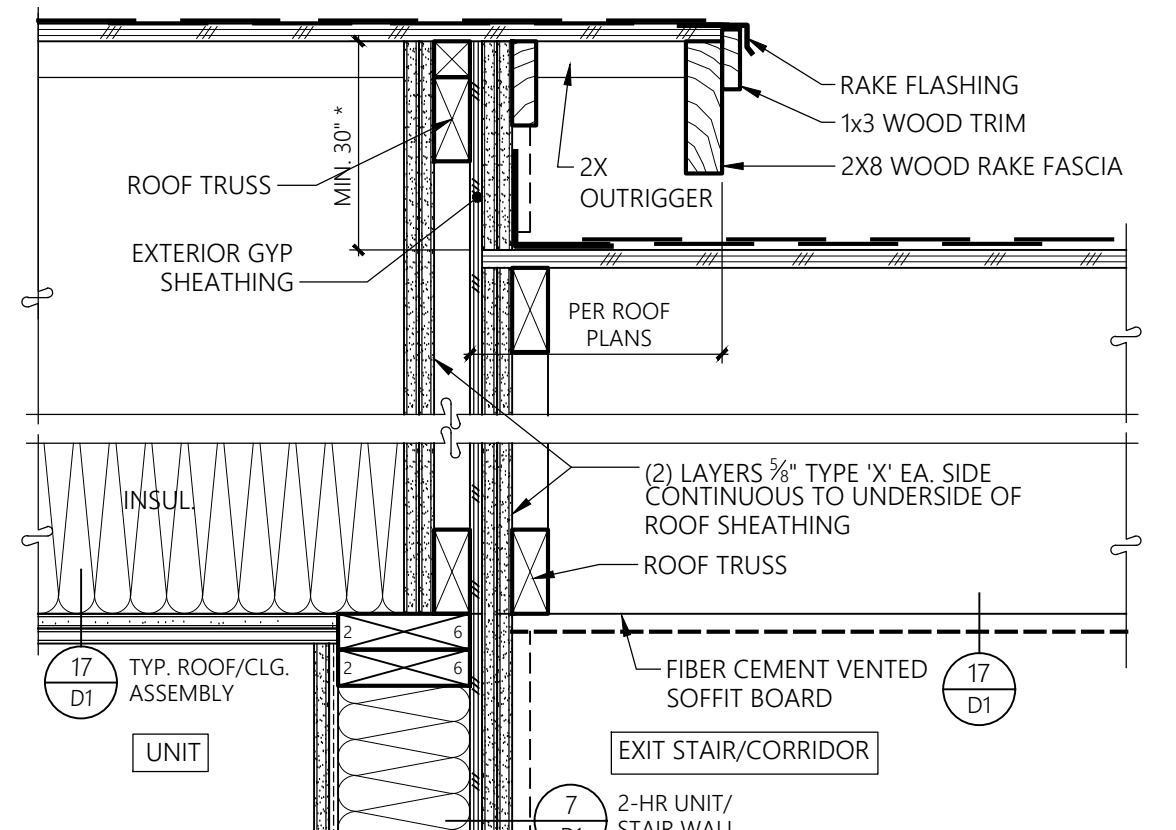


8 2-HR STAIR WALL AT ROOF
1-1/2" = 1'-0"

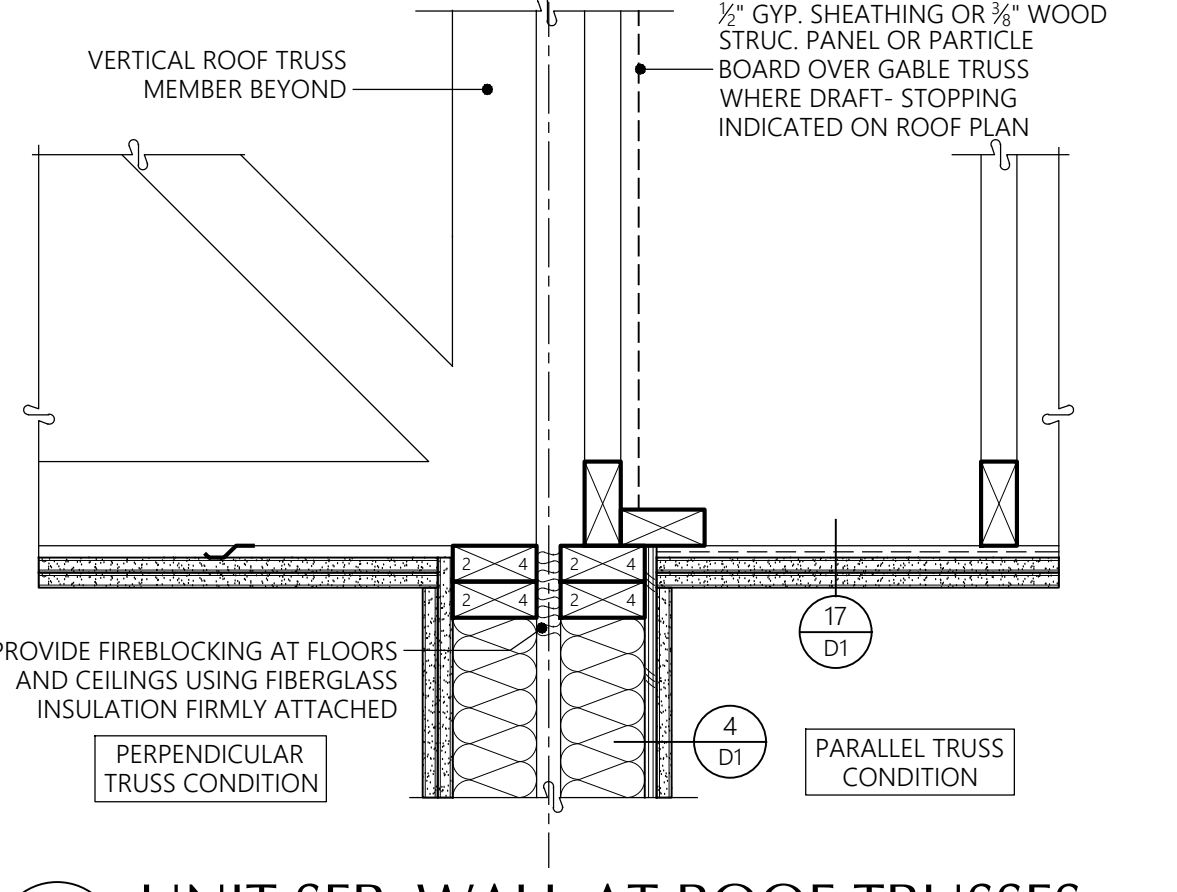


1 UNIT SEP. WALL AT ROOF TRUSSES
1-1/2" = 1'-0"

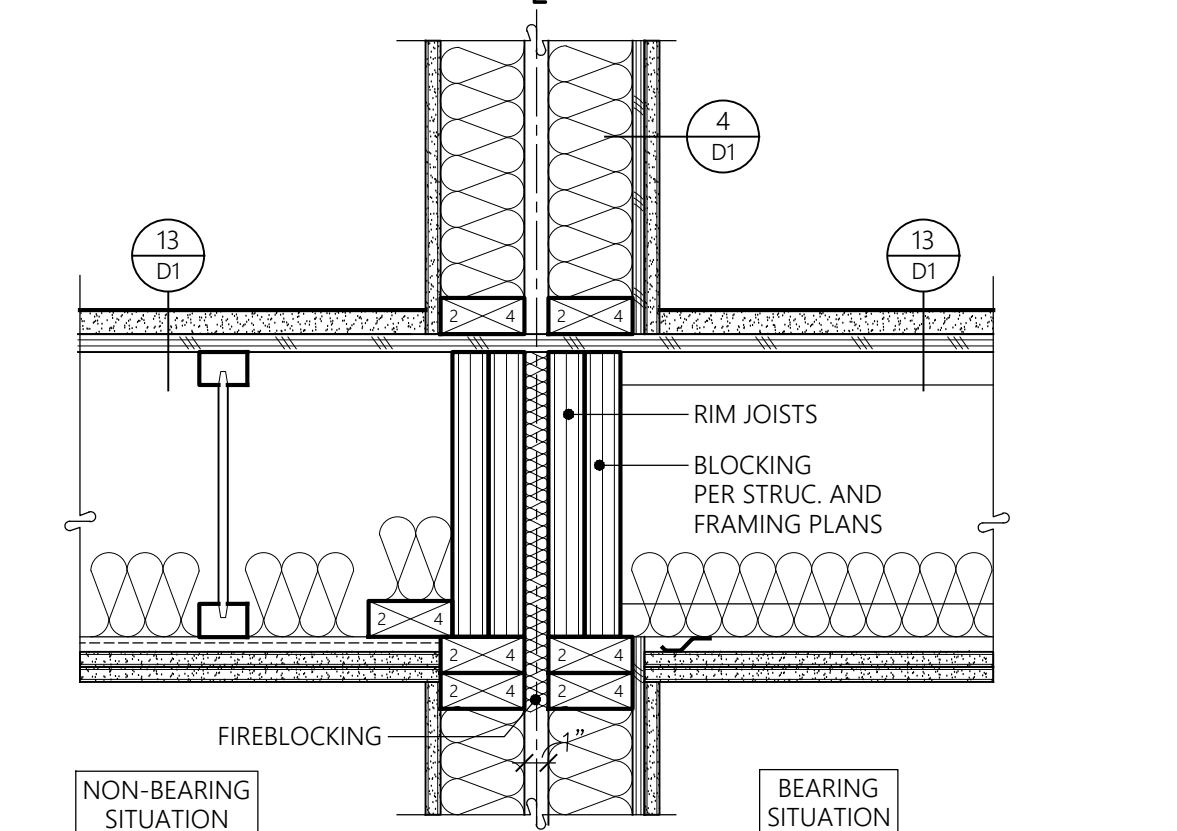

2 UNIT SEPAR. AT FLOOR
1-1/2" = 1'-0"

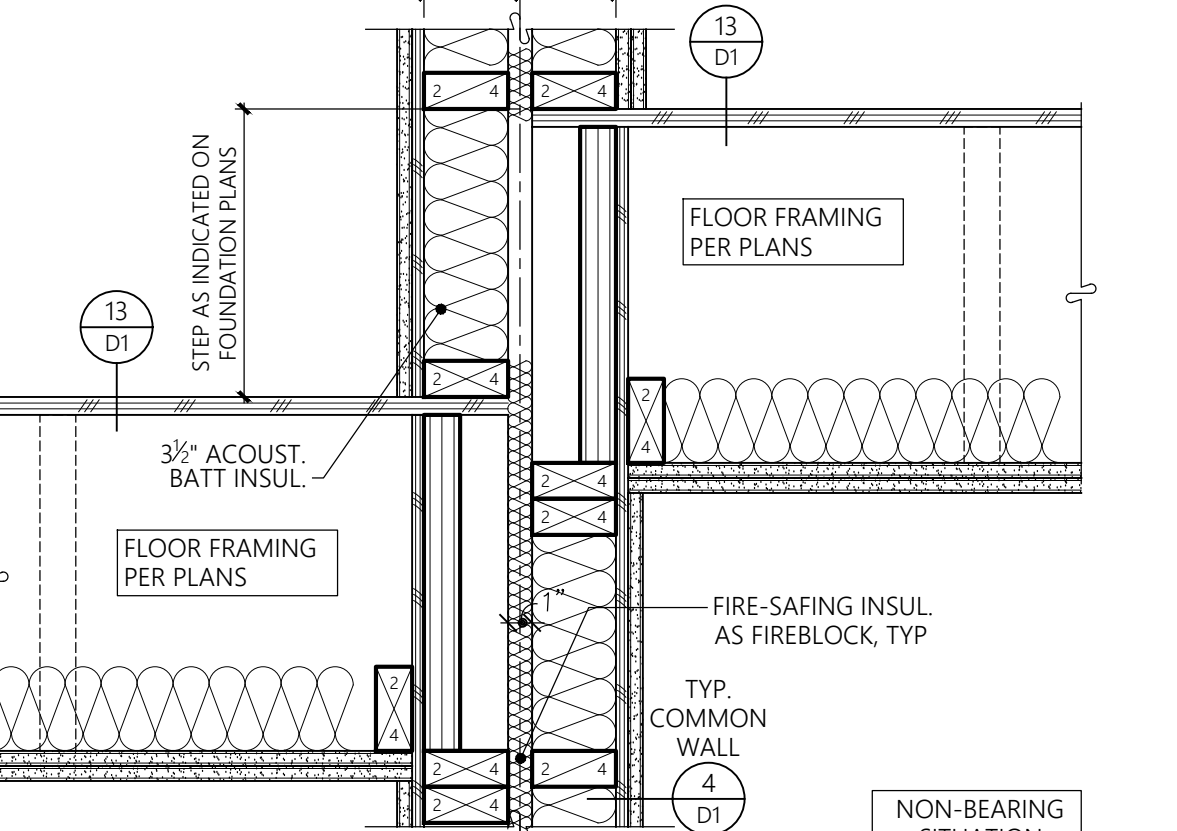


3 COMMON WALL AT STEPPED FLOOR
1-1/2" = 1'-0"

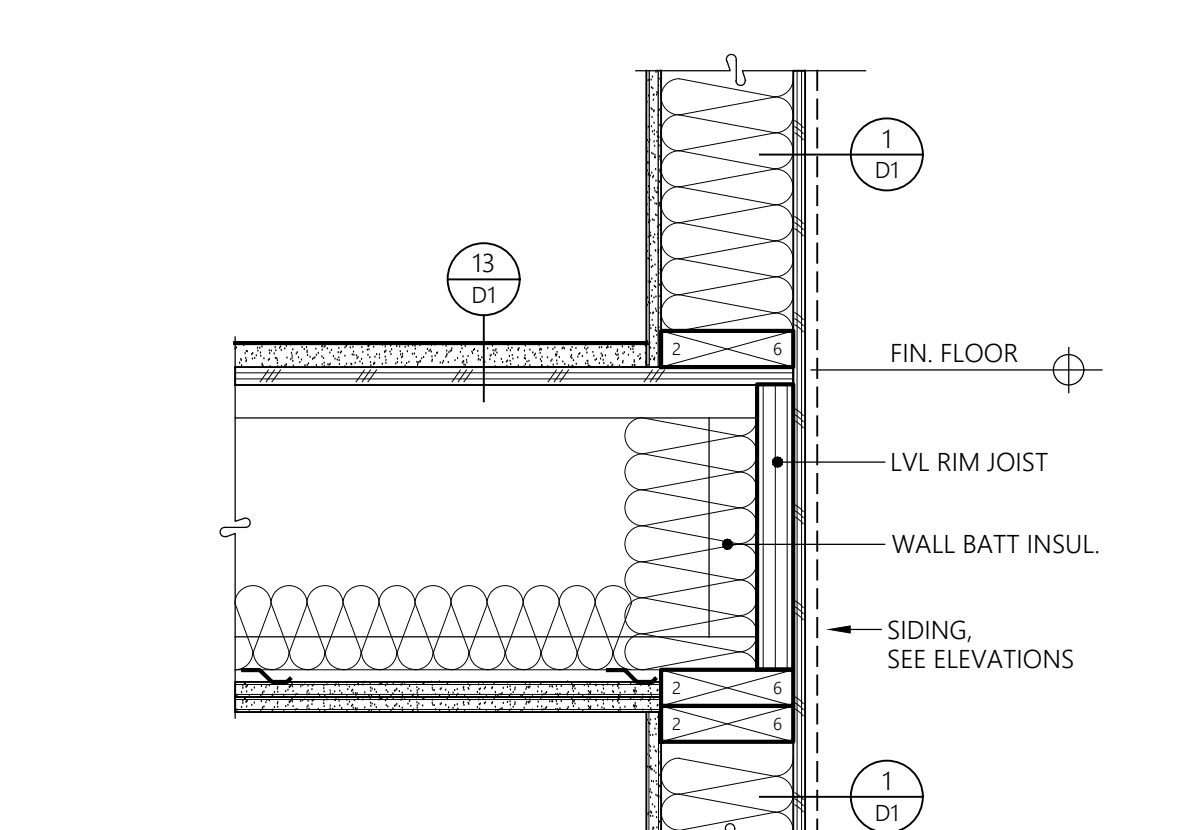


4 EXTERIOR WALL AT FLOOR
1-1/2" = 1'-0"


5 RIDGE VENT
1-1/2" = 1'-0"
SECTION

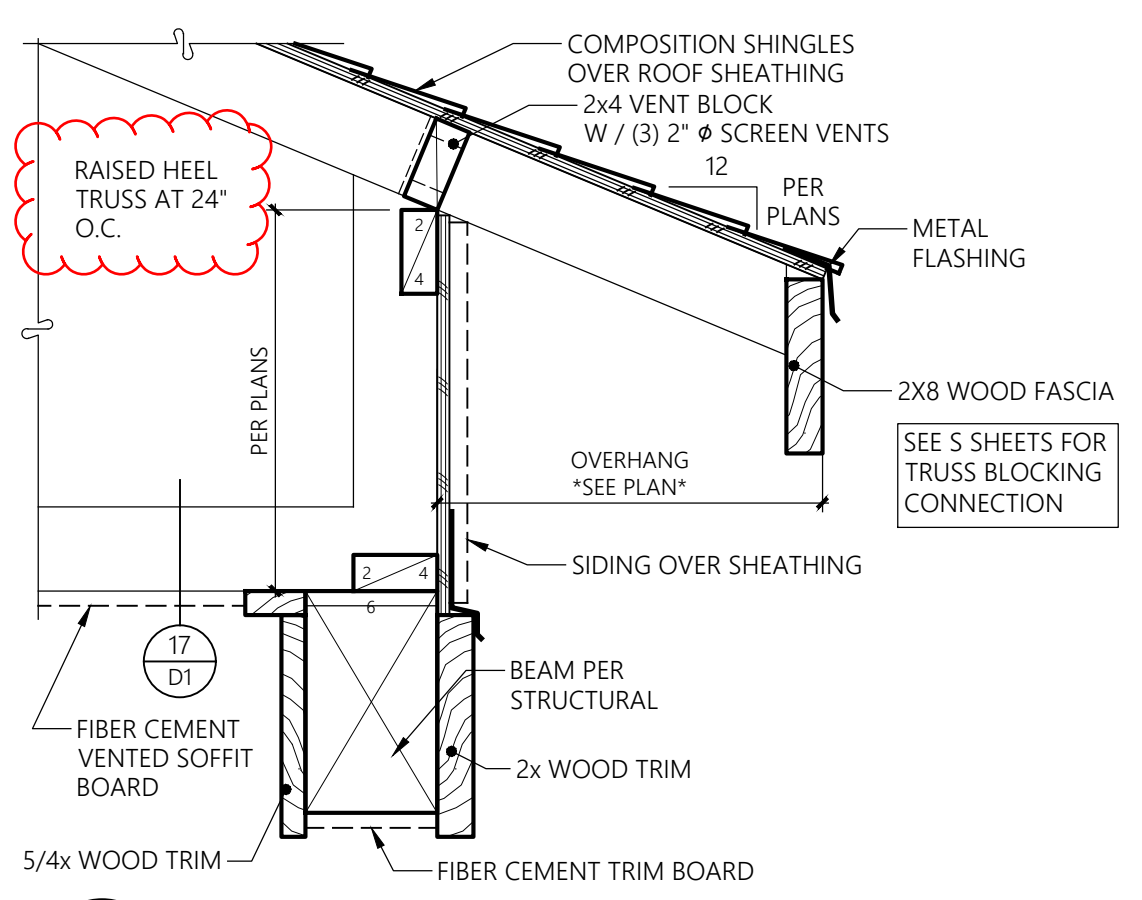

6 EAVE AT DECK HEADER
1-1/2" = 1'-0"
SECTION

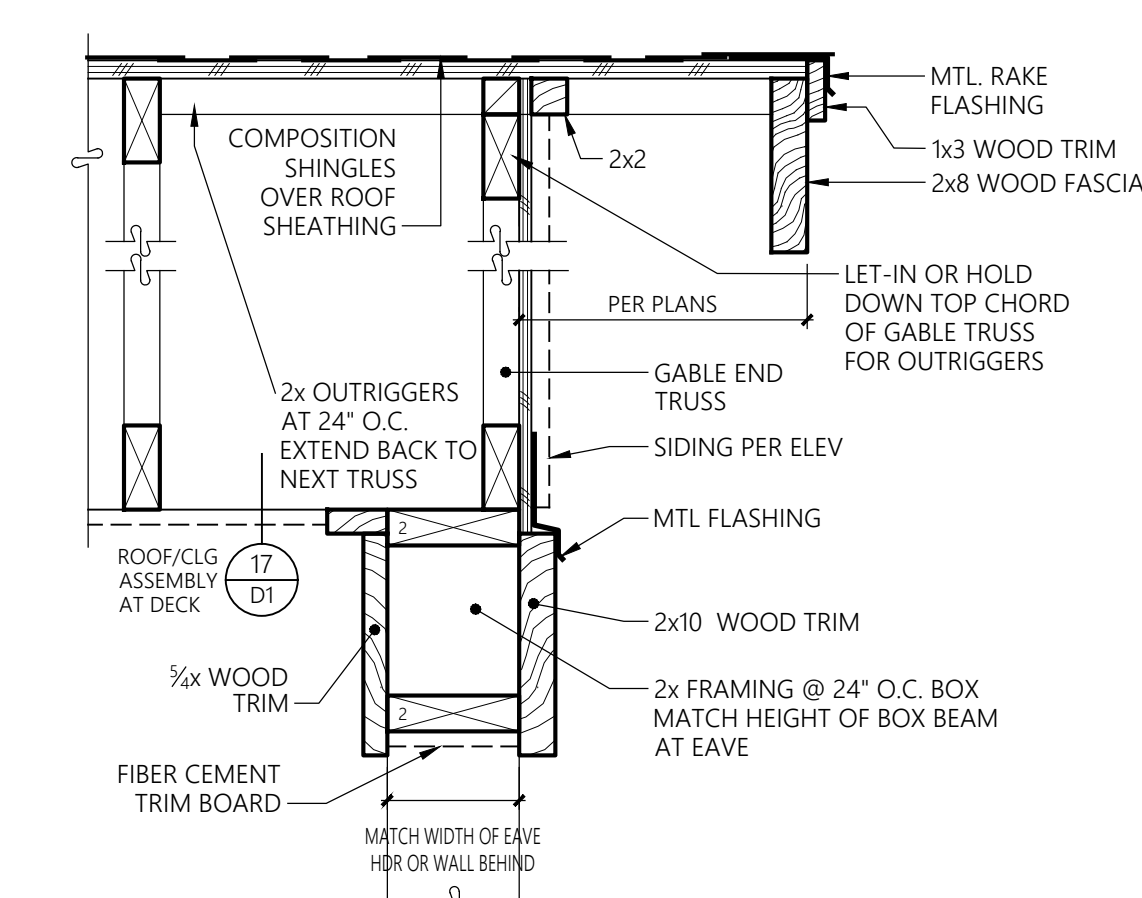


7 RAKE AT DECK
1-1/2" = 1'-0"
SECTION

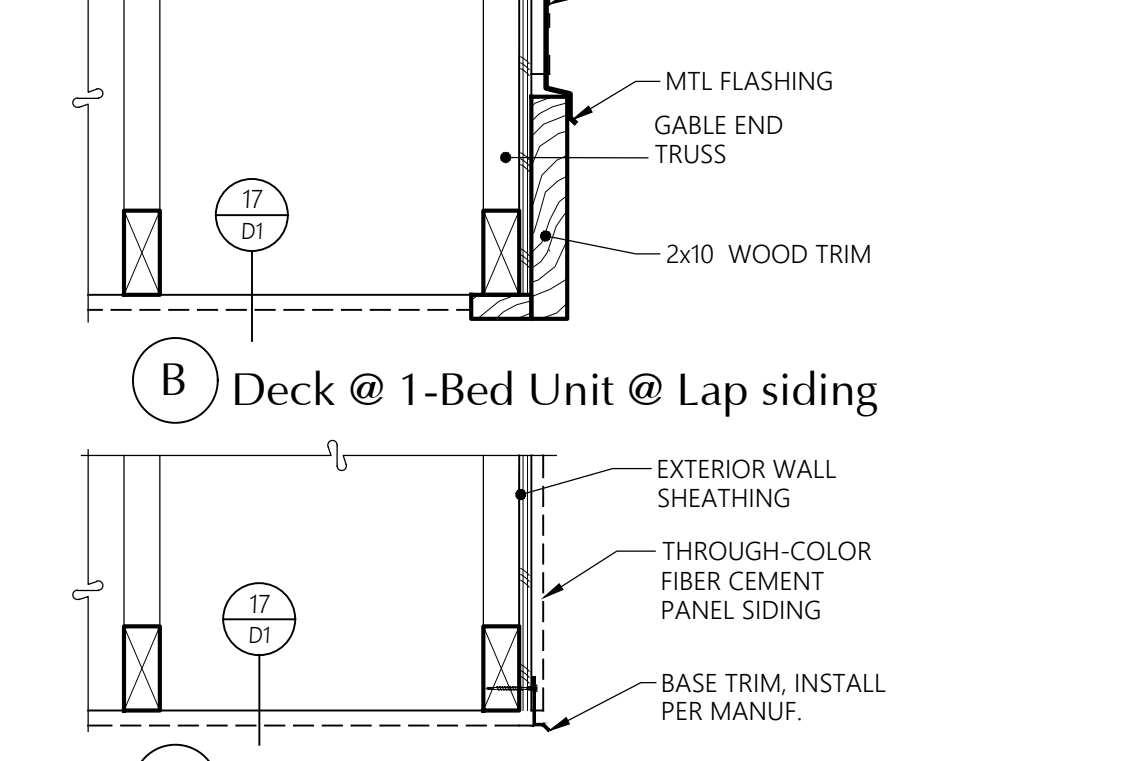


7 RAKE AT DECK
1-1/2" = 1'-0"
SECTION


1 EAVE OVERHANG
1-1/2" = 1'-0"
SECTION

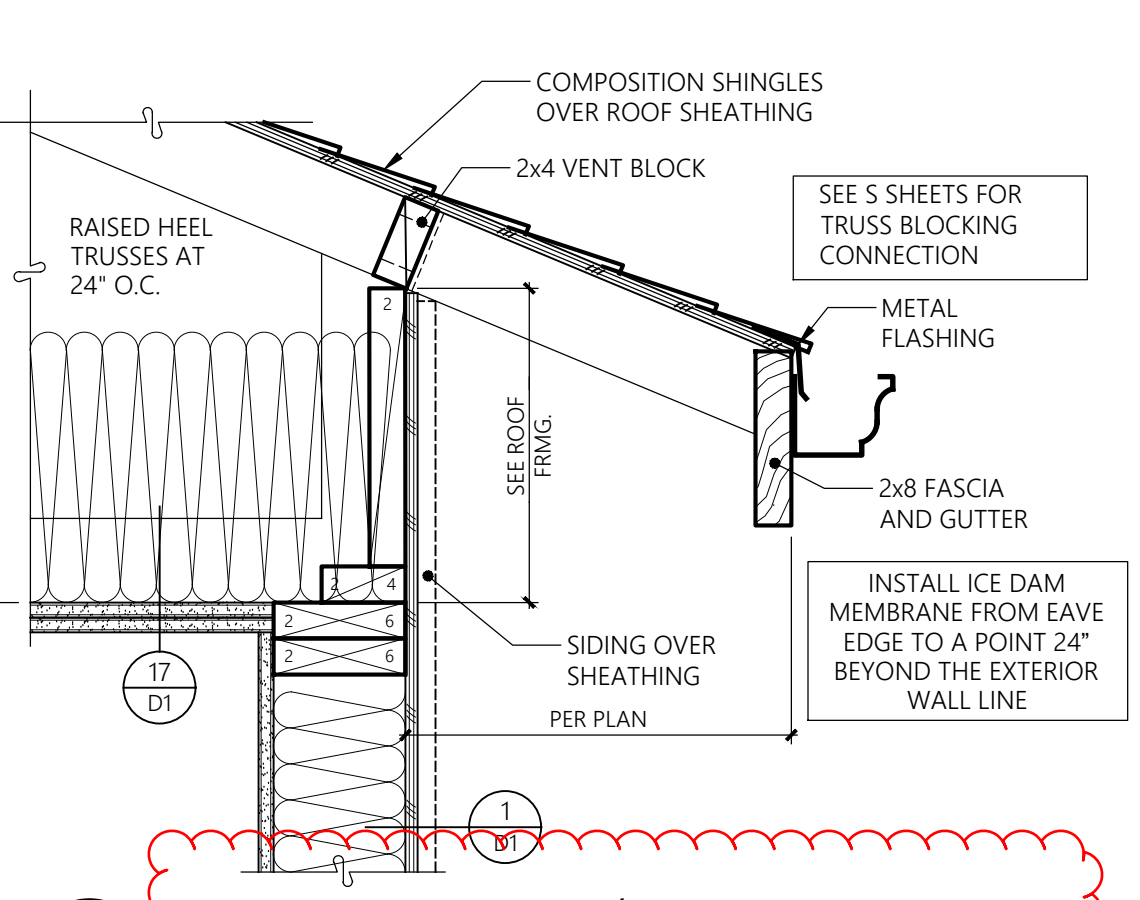

2 OVERHANG W/ RAISED HEEL
1-1/2" = 1'-0"
SECTION

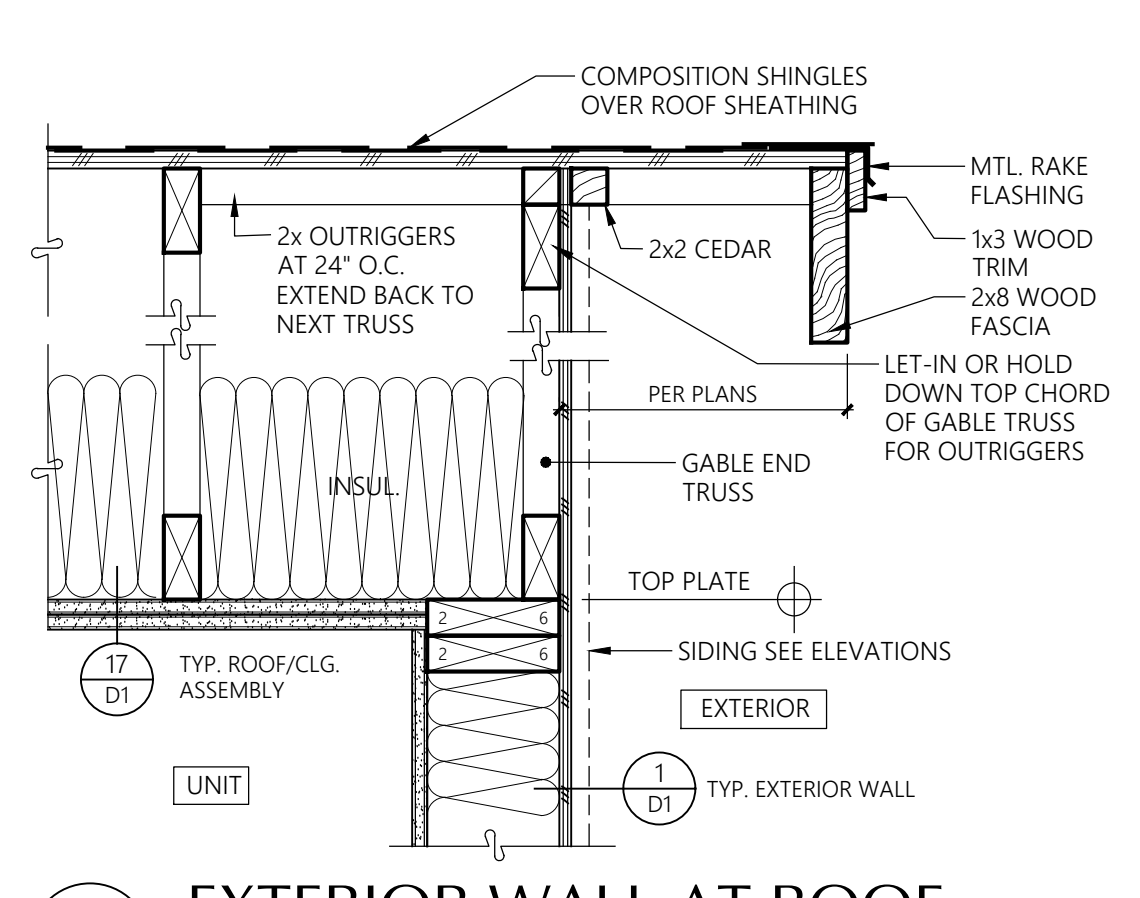


3 EXTERIOR WALL AT ROOF
1-1/2" = 1'-0"
SECTION

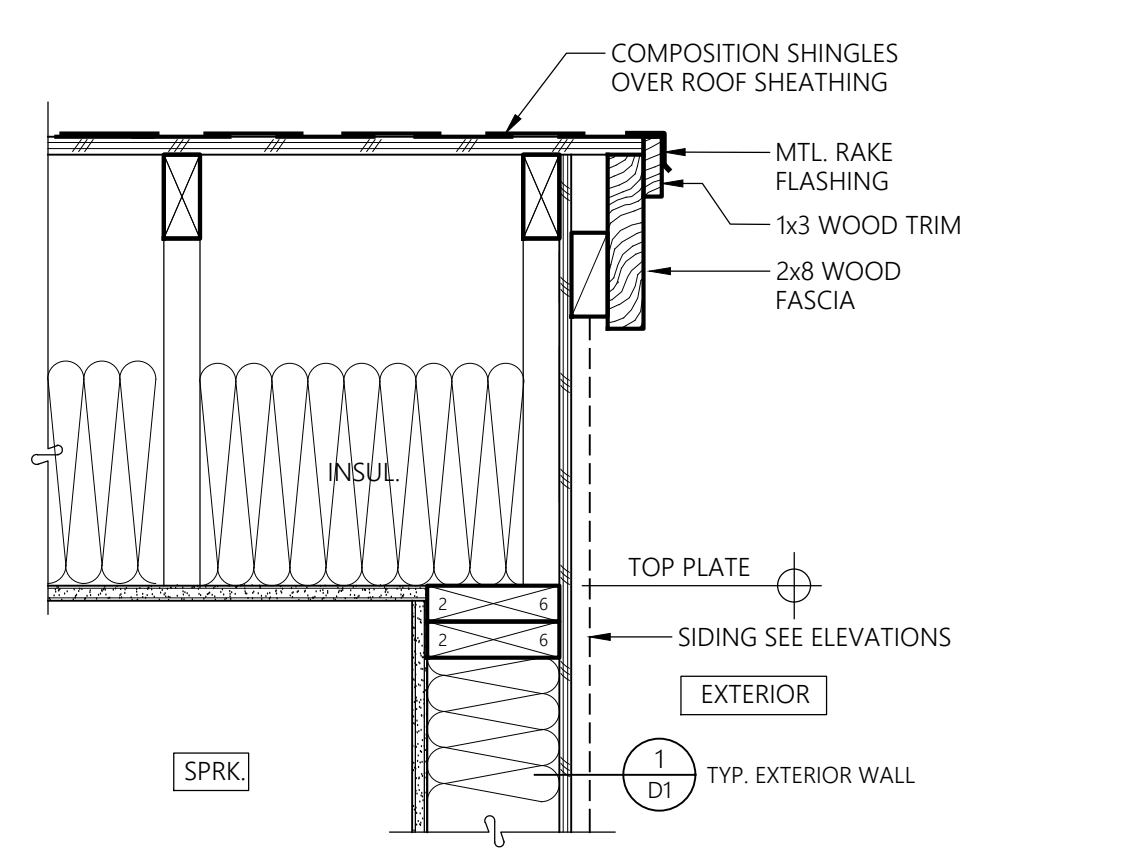


4 SPRK./ELEC. ROOM RAKE
1-1/2" = 1'-0"
SECTION


13 EXIT STAIR ROOF OVERHANG
1-1/2" = 1'-0"
SECTION

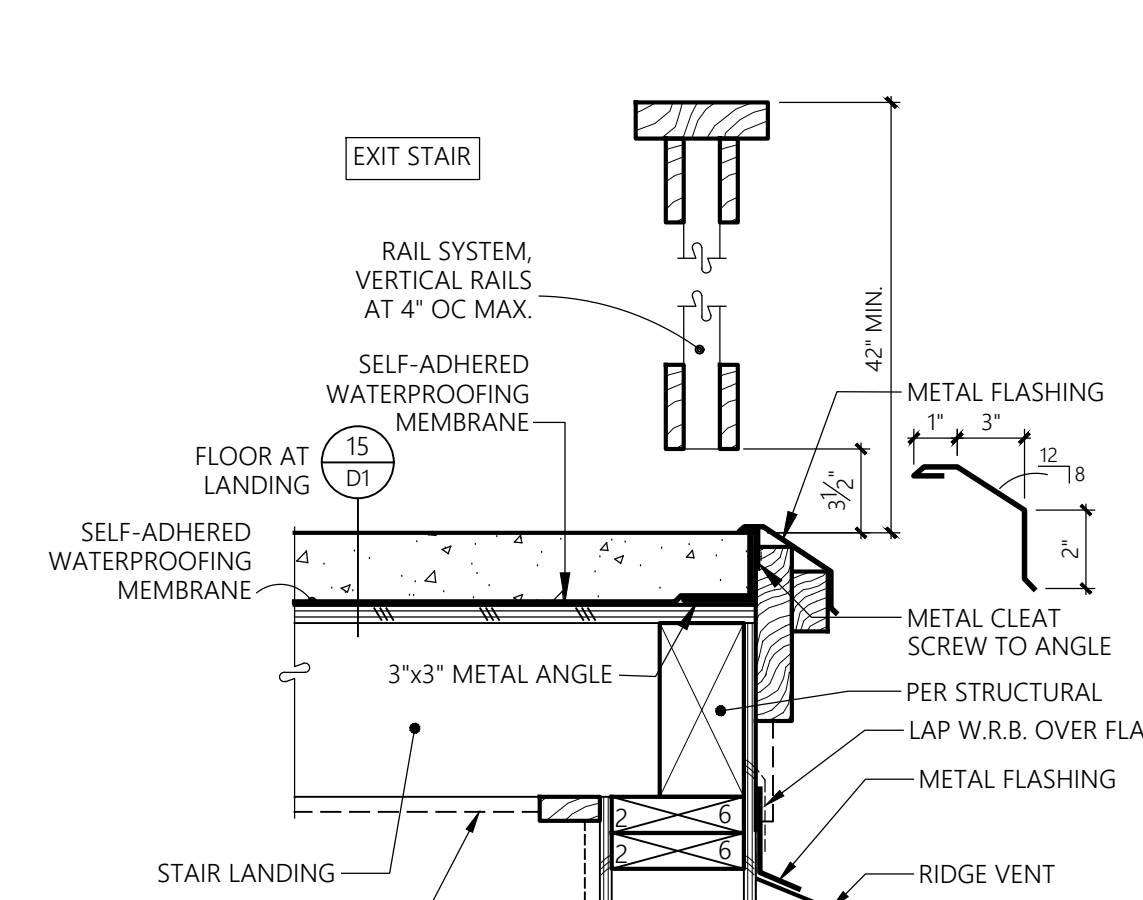

15 GUARD AT LANDING
1-1/2" = 1'-0"
SECTION

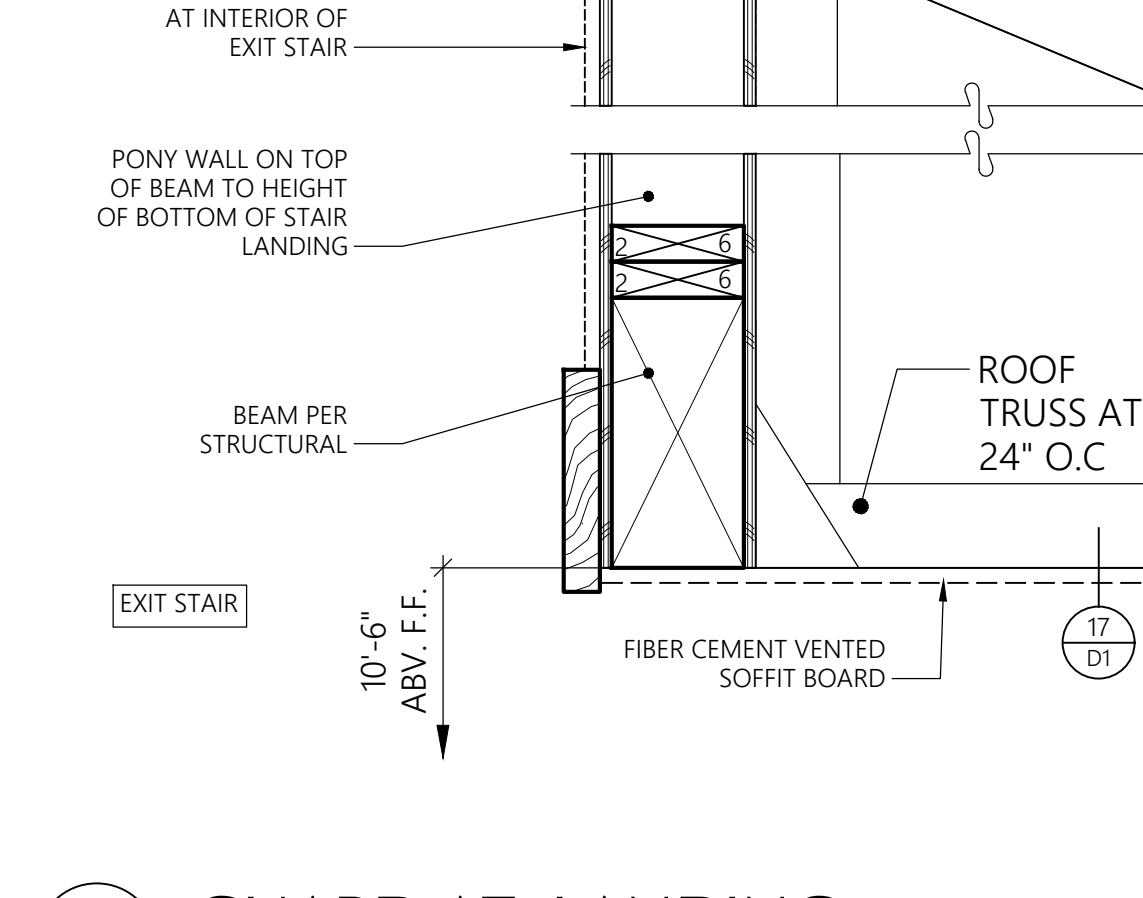

16 LOW ROOF
1-1/2" = 1'-0"
SECTION

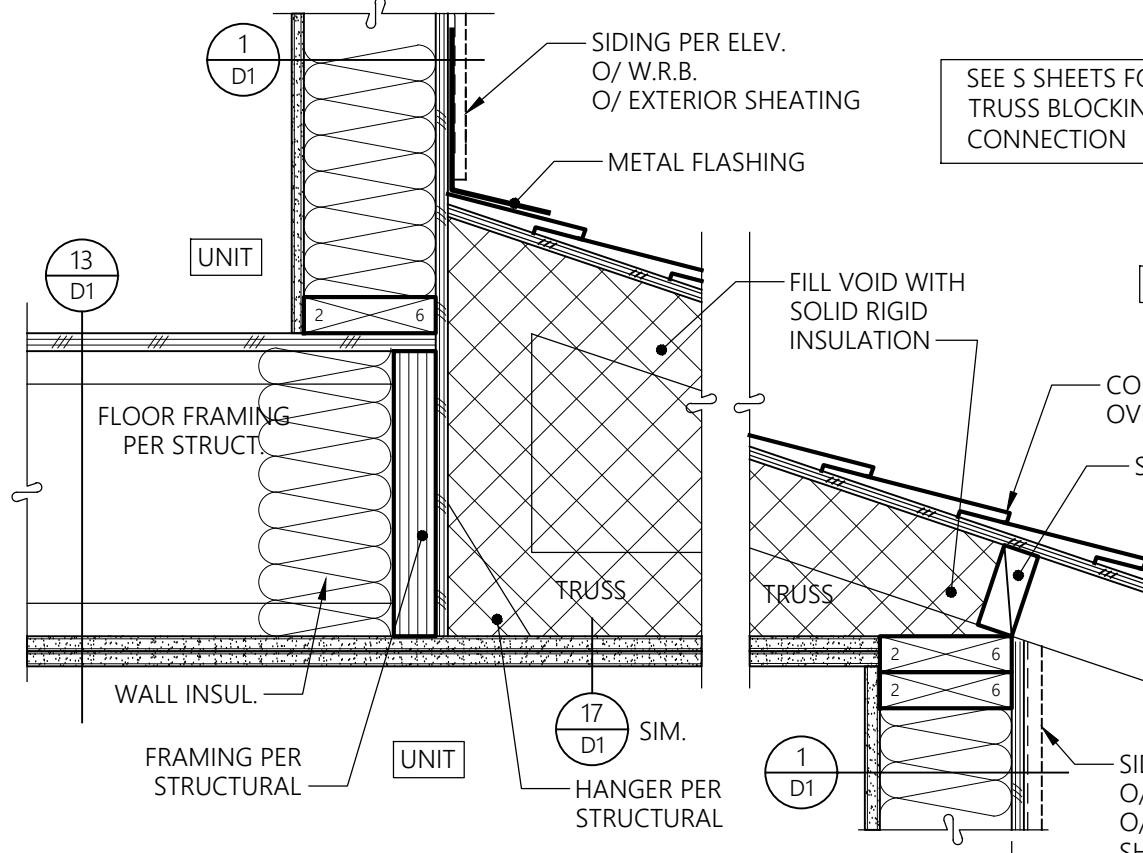

16 LOW ROOF
1-1/2" = 1'-0"
SECTION


9 EXIT STAIR ROOF
1-1/2" = 1'-0"
SECTION



17 ENTRY BOX-BEAM DETAILS
1-1/2" = 1'-0"
SECTION




17 ENTRY BOX-BEAM DETAILS
1-1/2" = 1'-0"
SECTION

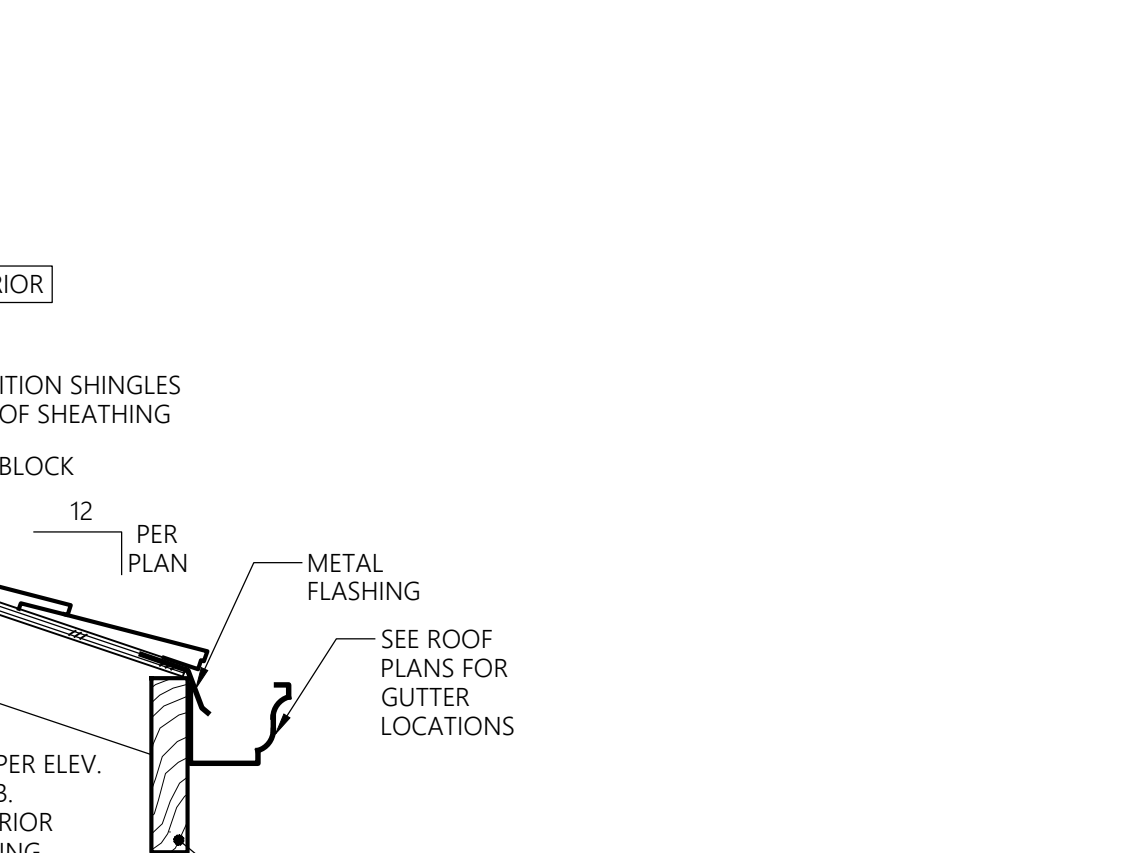


17 ENTRY BOX-BEAM DETAILS
1-1/2" = 1'-0"
SECTION


A BOX BEAM AT RAKE
1-1/2" = 1'-0"
SECTION

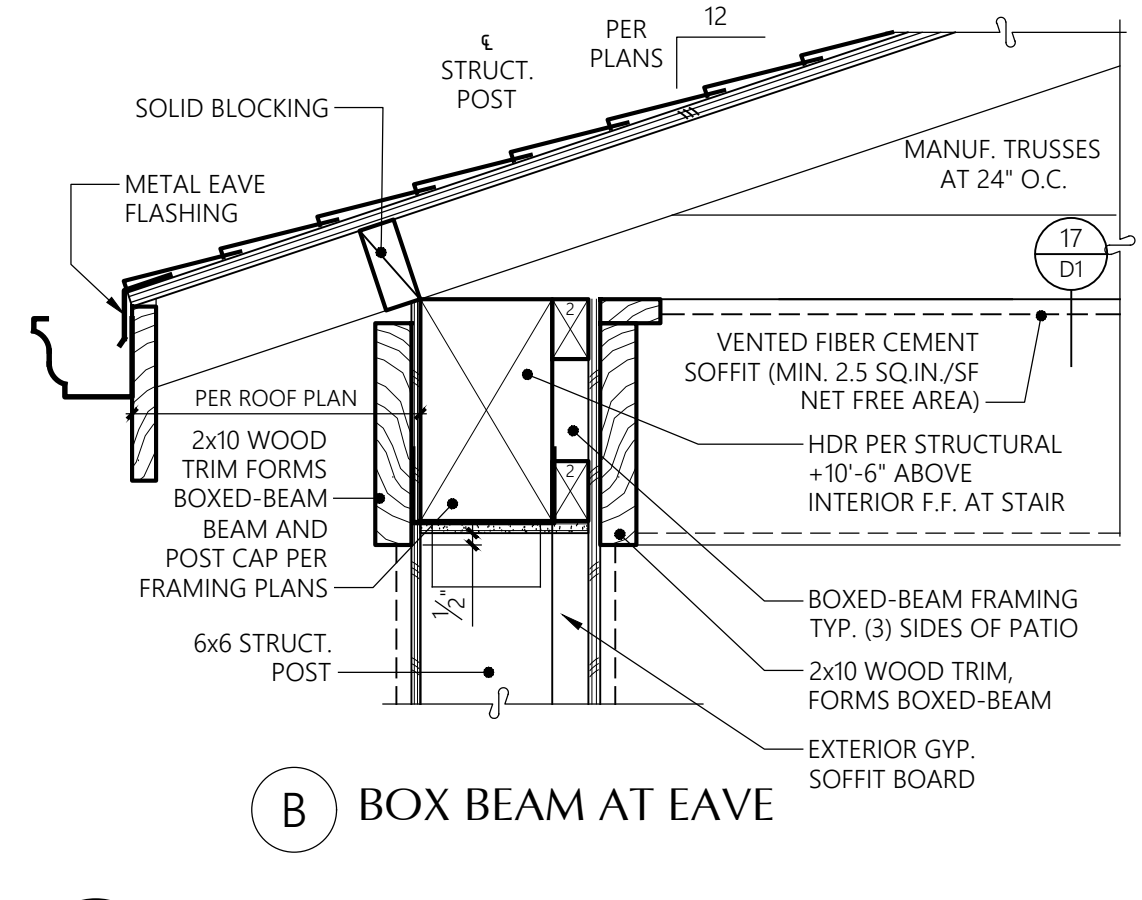

B BOX BEAM AT EAVE
1-1/2" = 1'-0"
SECTION

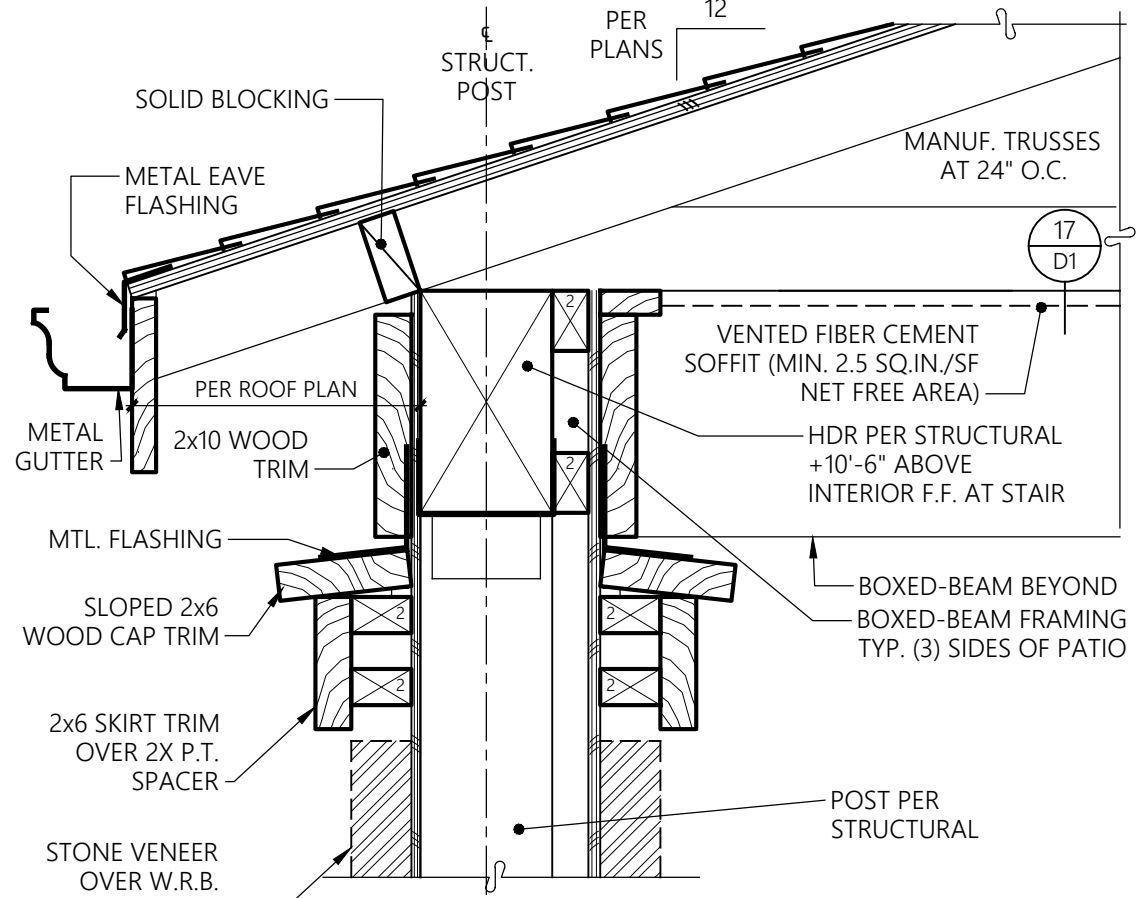

17 ENTRY BOX-BEAM DETAILS
1-1/2" = 1'-0"
SECTION

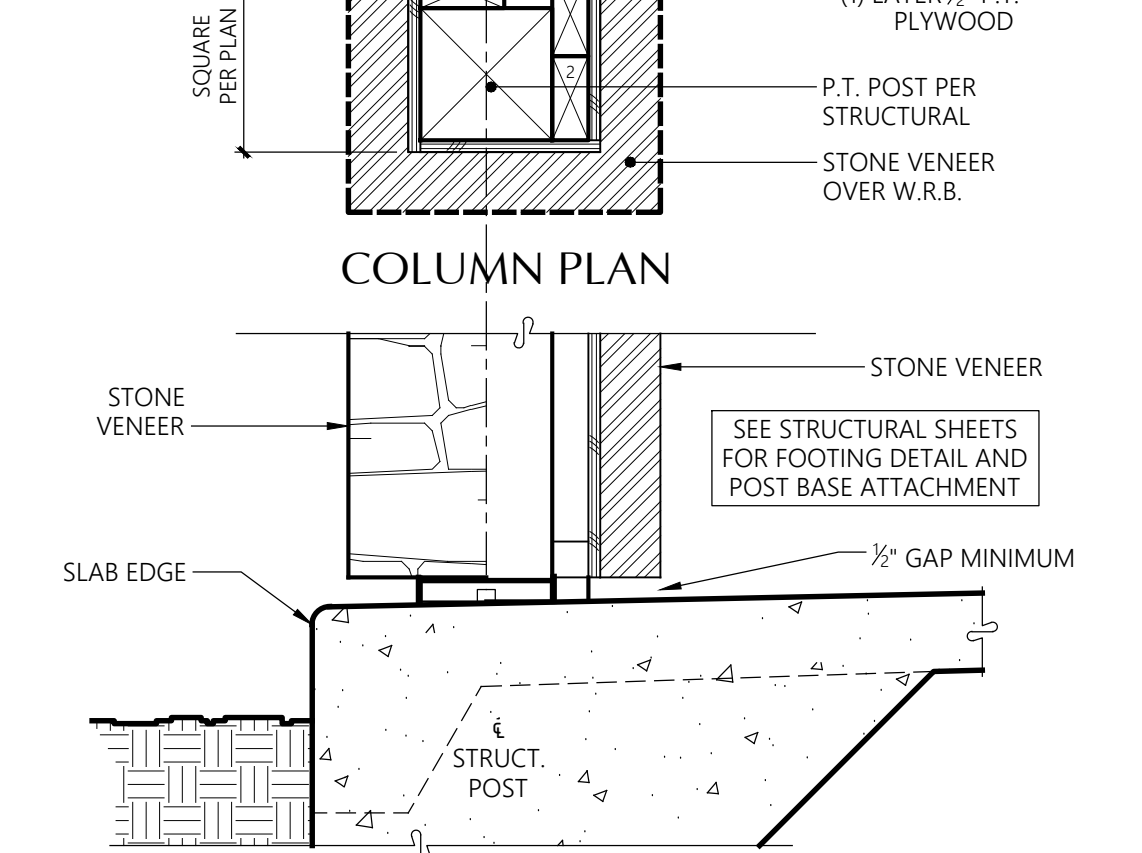


20 ENTRY COLUMN AND LOW ROOF
1-1/2" = 1'-0"
SECTION




20 ENTRY COLUMN AND LOW ROOF
1-1/2" = 1'-0"
SECTION


FR 2306 VERTICALS (01-10) DWG

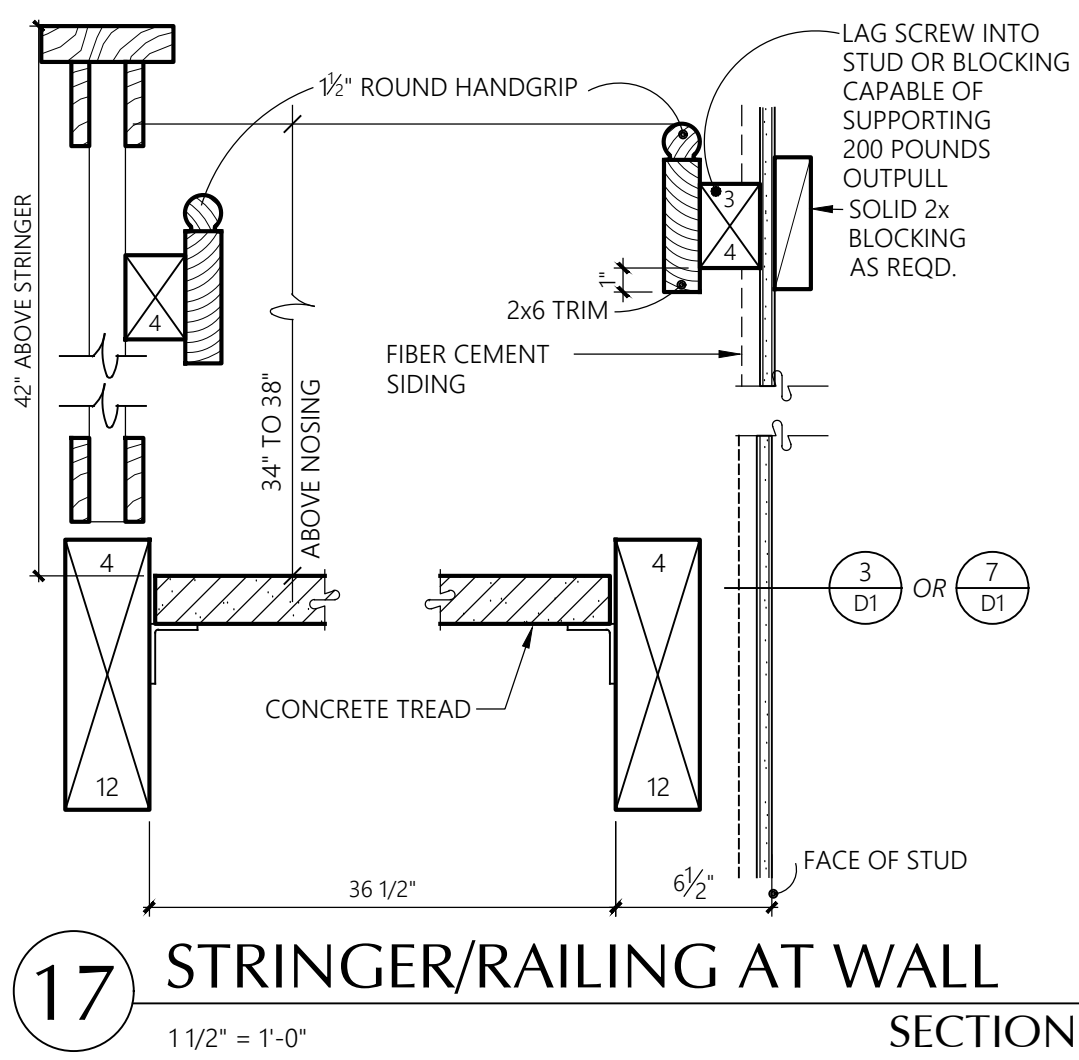


17 STRINGER/RAILING AT WALL
SECTION
1 1/2" = 1'-0"

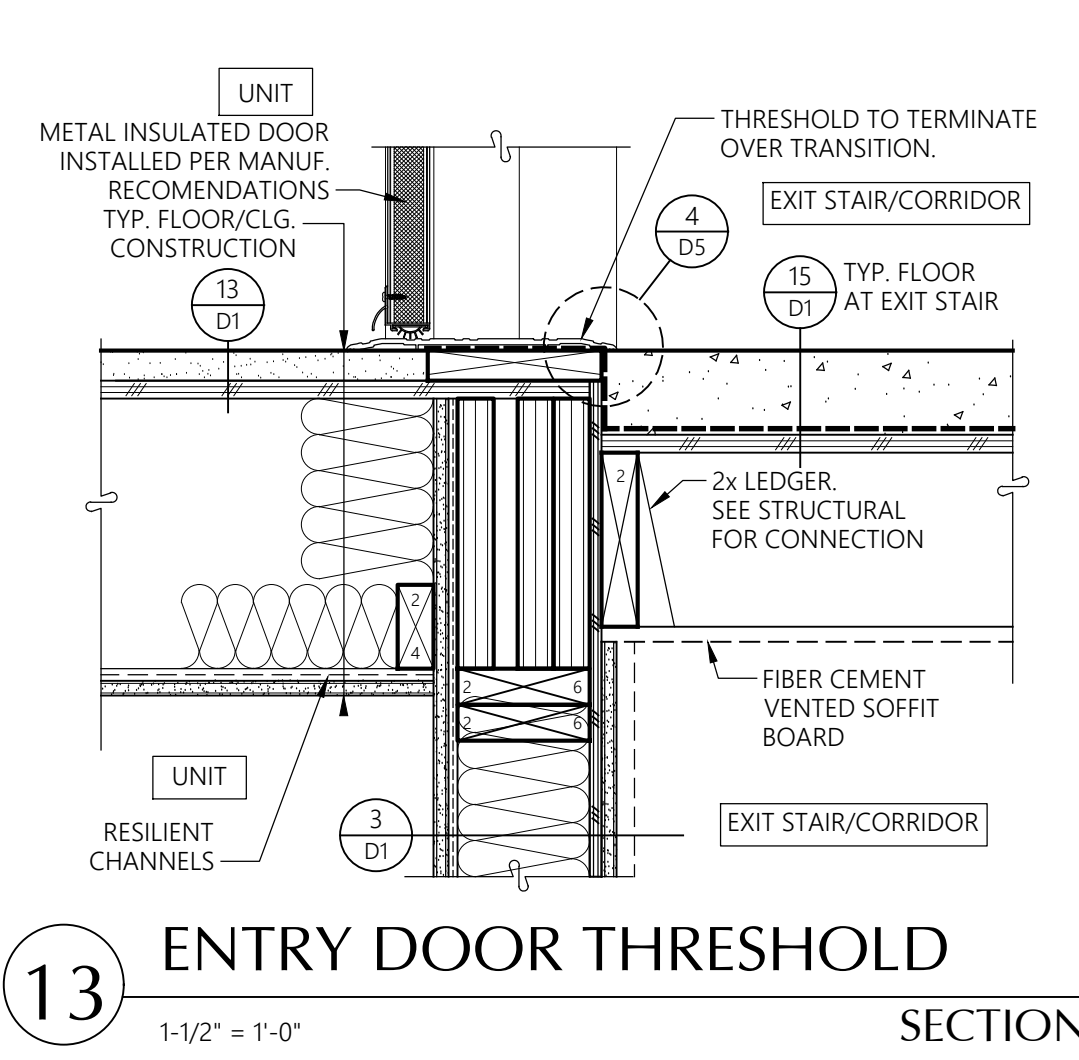

13 ENTRY DOOR THRESHOLD
SECTION
1-1/2" = 1'-0"

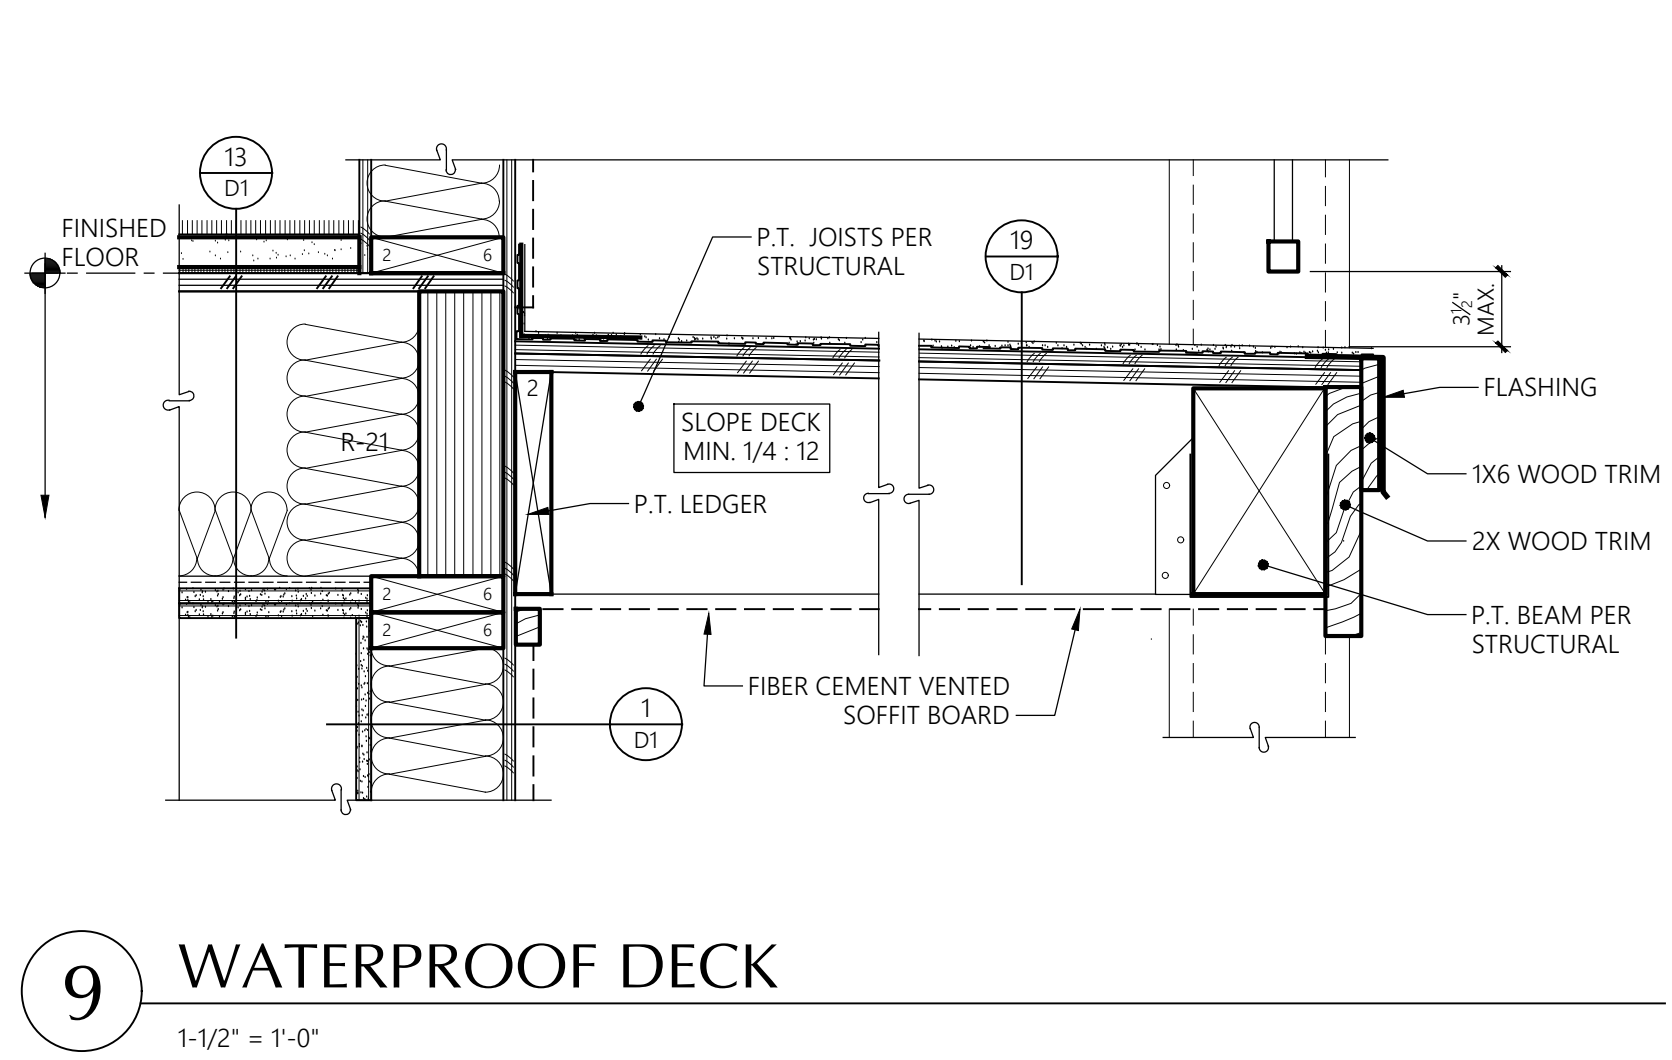


9 WATERPROOF DECK
SECTION
1-1/2" = 1'-0"

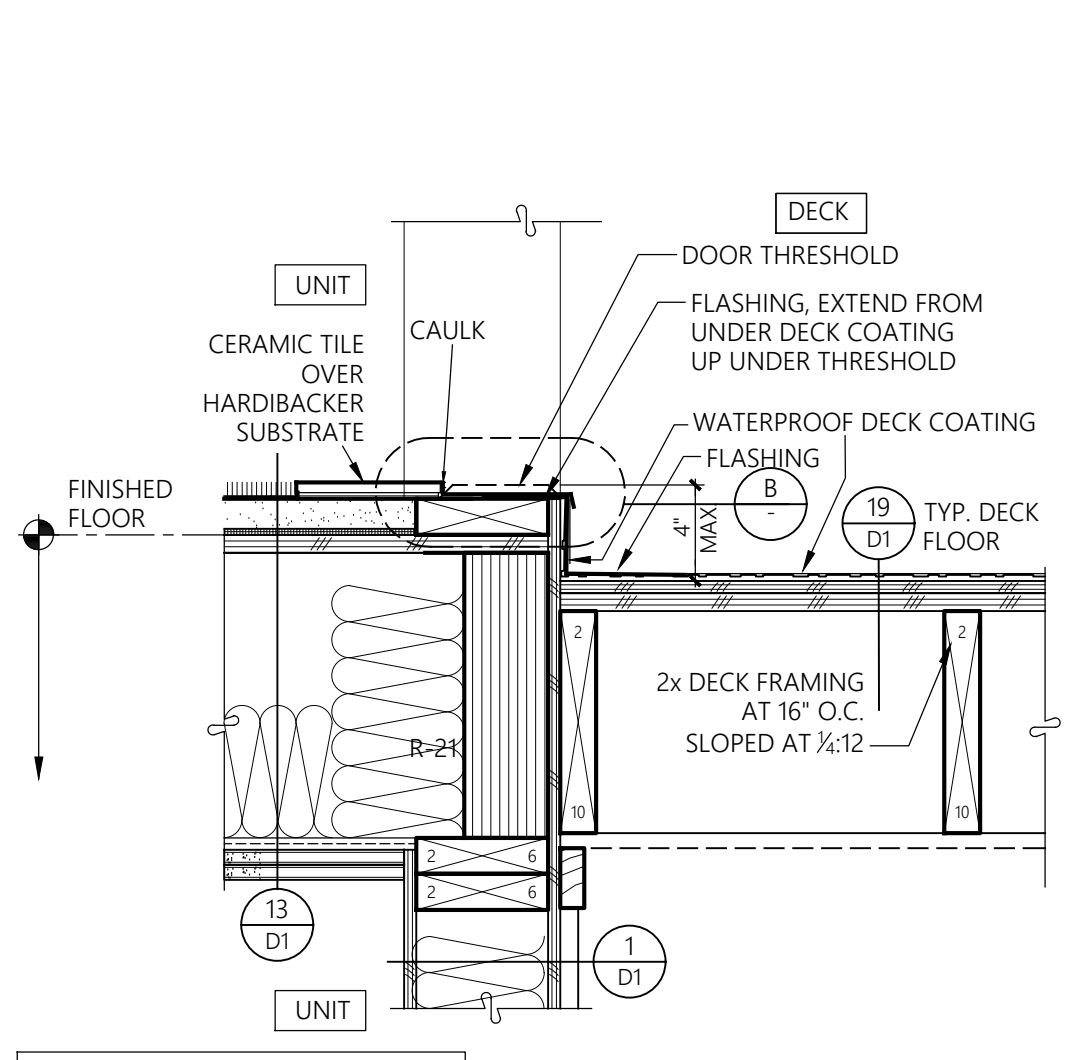


NOTE: SEE STRUCTURAL DETAIL SHEETS FOR ALL POST AND BEAM CONNECTIONS.


A PATIO SWING DOOR STANDARD THRESHOLD

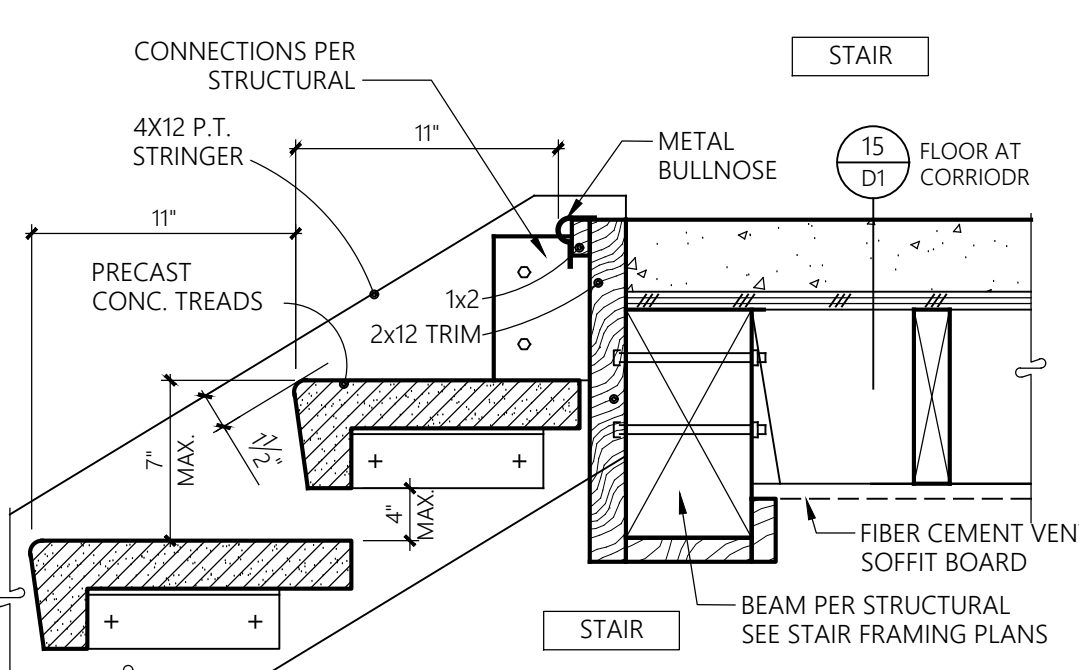


18 UPPER FLOOR STAIR DETAIL
SECTION
1 1/2" = 1'-0"

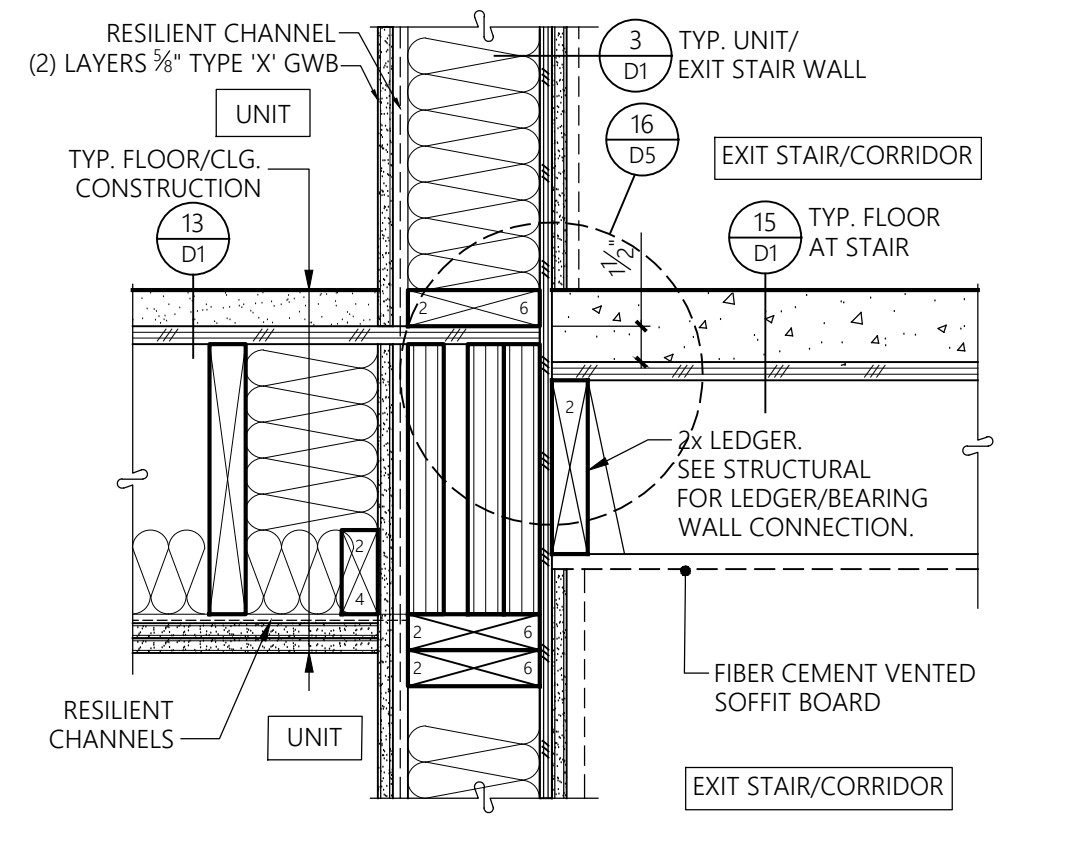


14 STAIR WALL AT FLOOR
SECTION
1-1/2" = 1'-0"

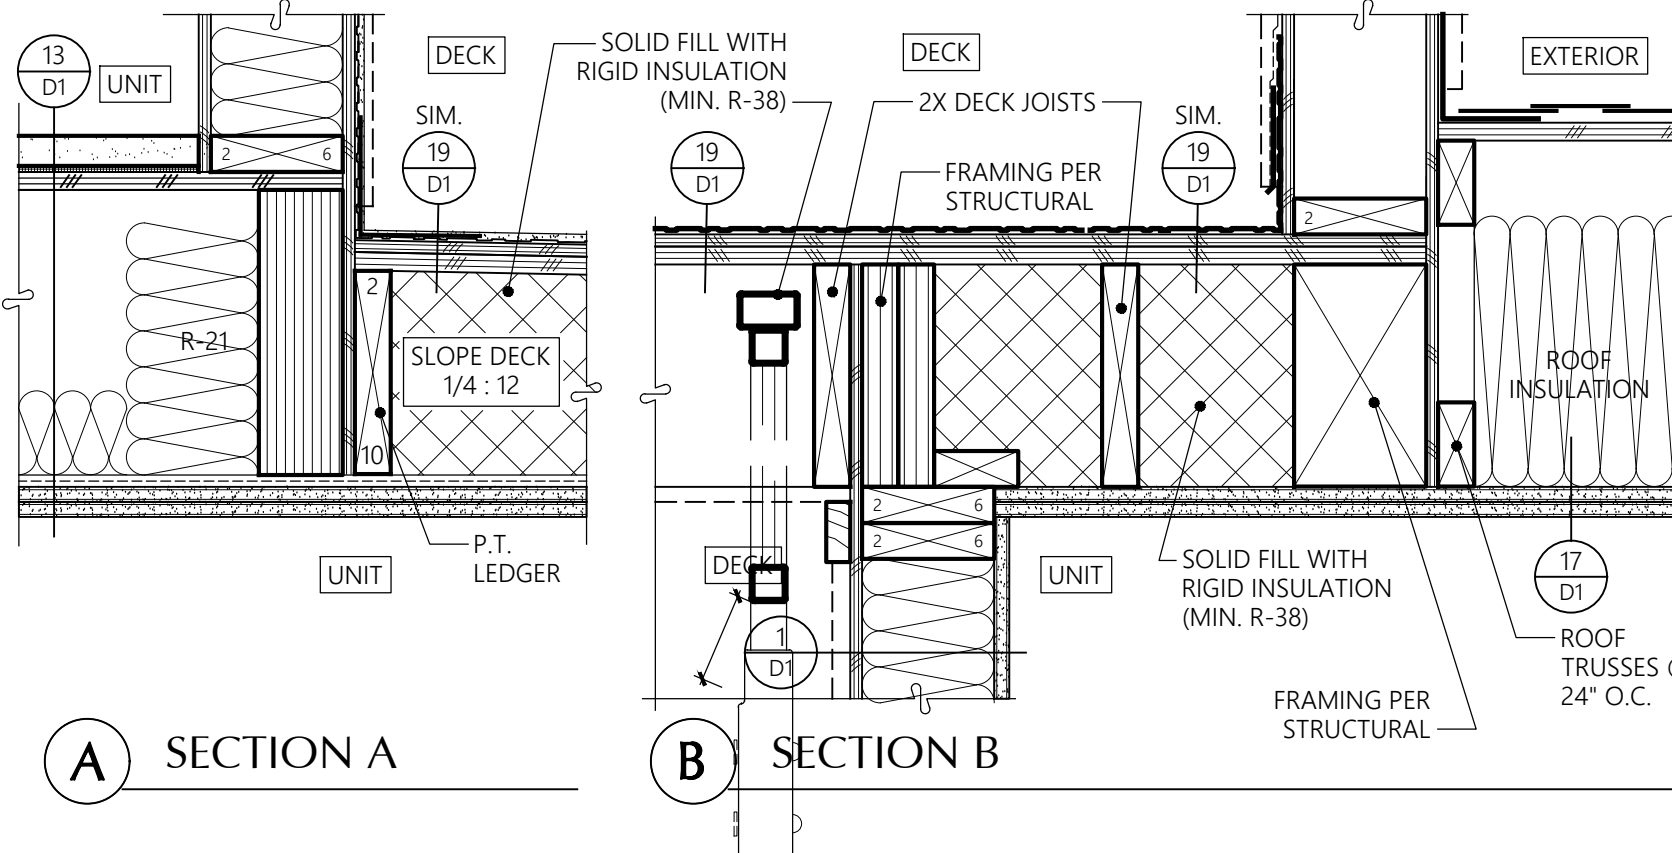


10 DECK OVER UNIT BELOW
SECTION
1-1/2" = 1'-0"

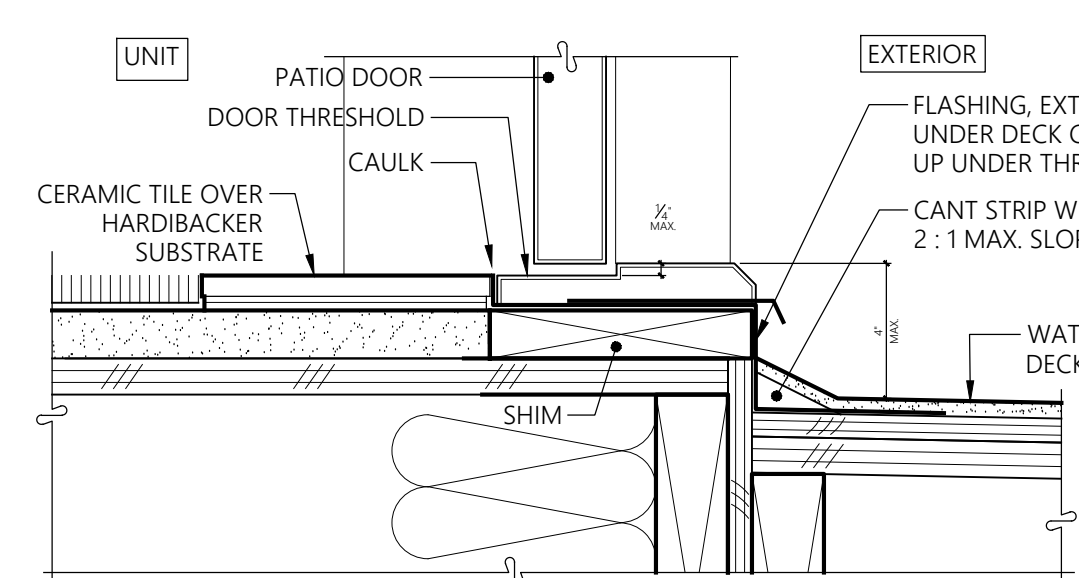


B PATIO SWING DOOR STANDARD THRESHOLD

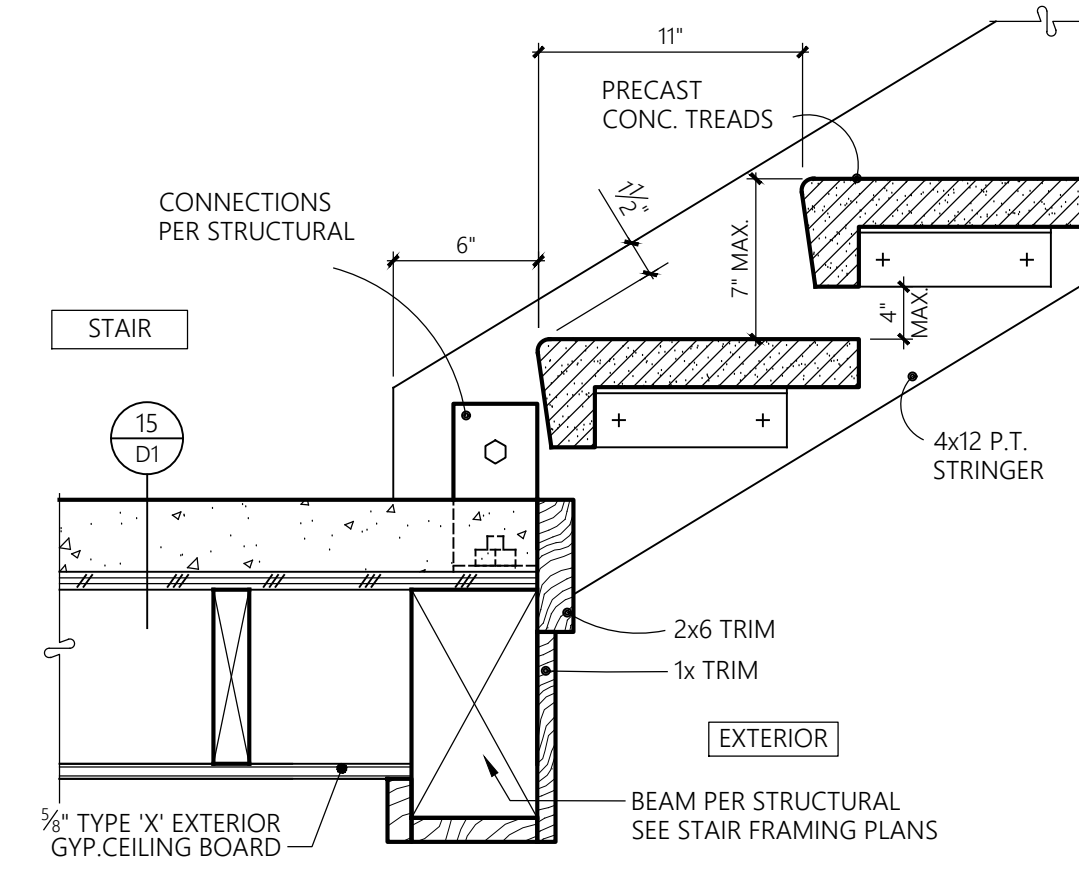


19 UPPER FLOOR STAIR DETAIL
SECTION
1 1/2" = 1'-0"

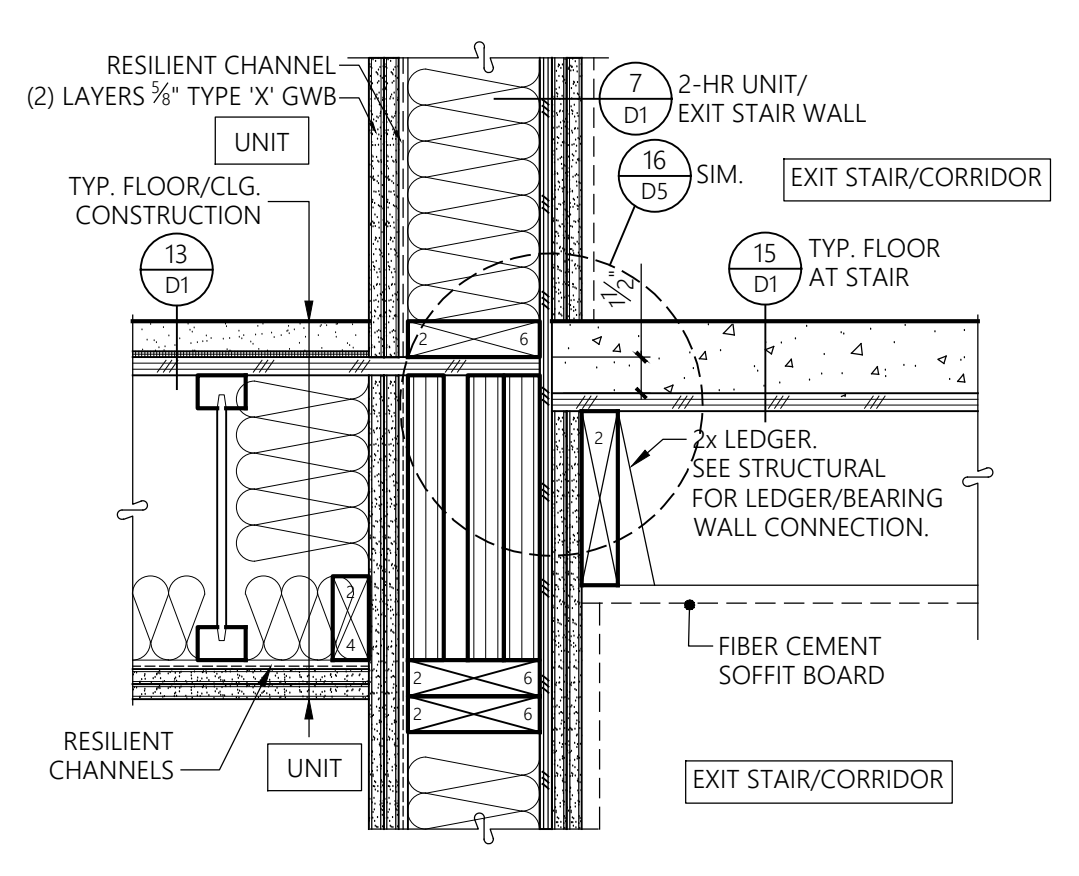


15 2-HR STAIR WALL AT FLOOR
SECTION
1-1/2" = 1'-0"

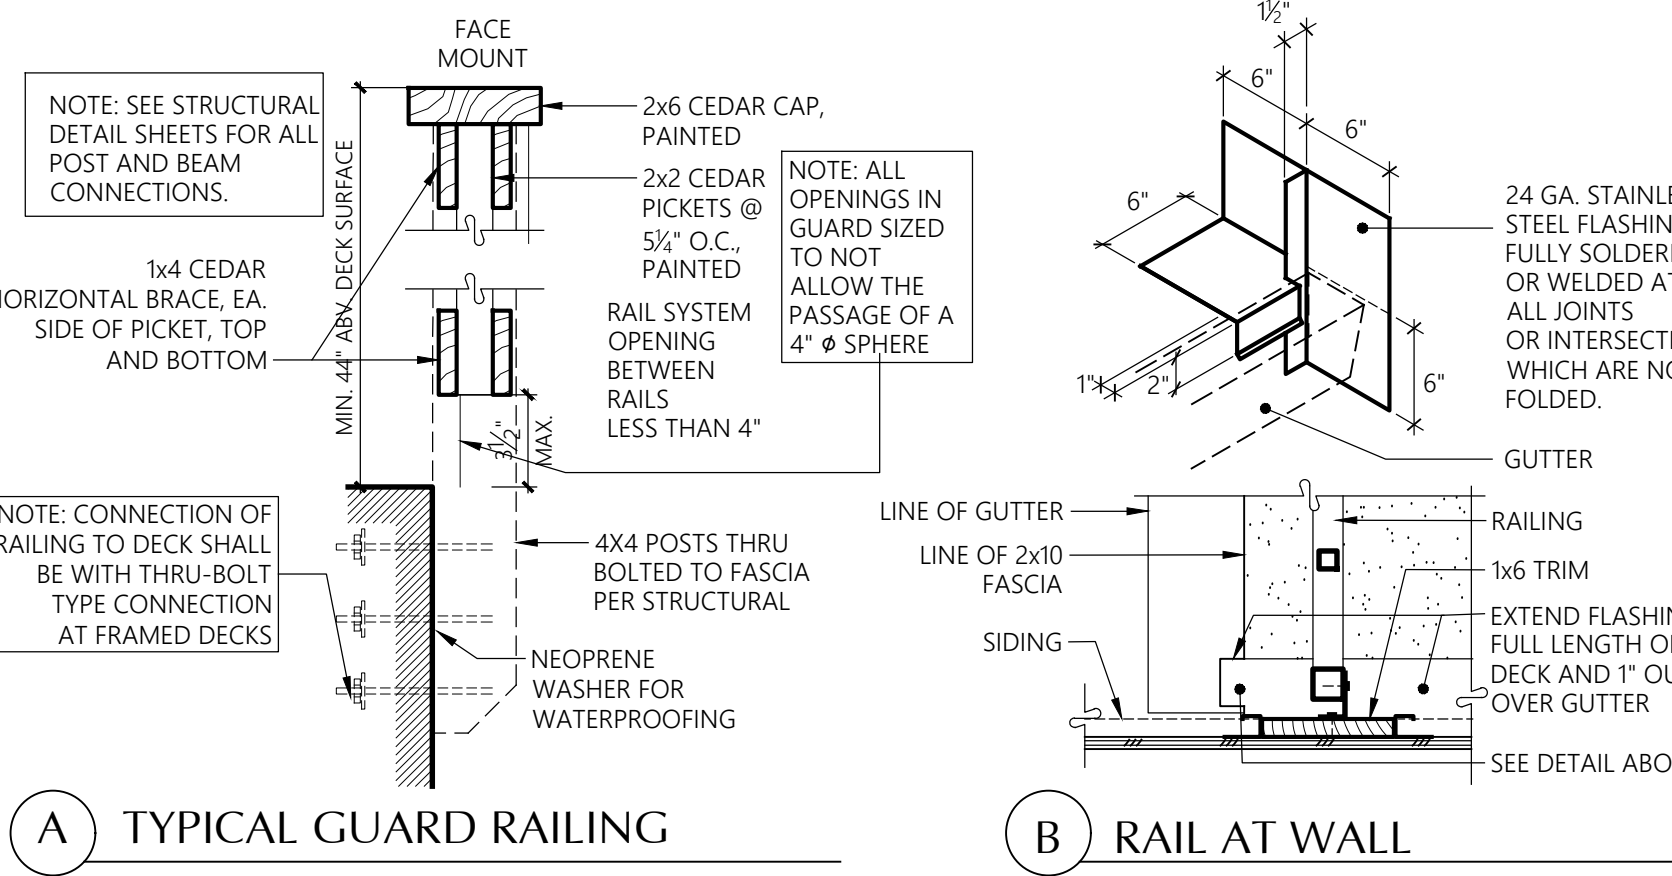


11 GUARD RAIL DETAILS
SECTION
1-1/2" = 1'-0"

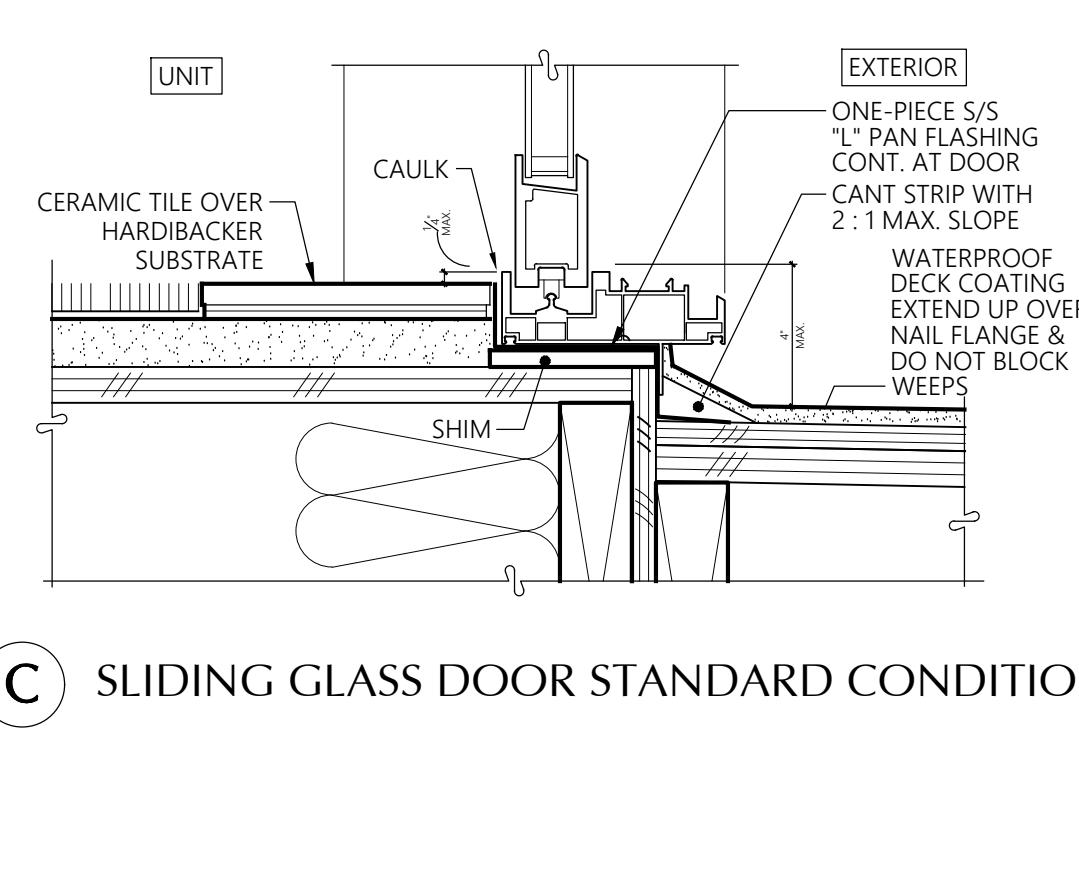


2 DECK THRESHOLD DETAILS
SECTION

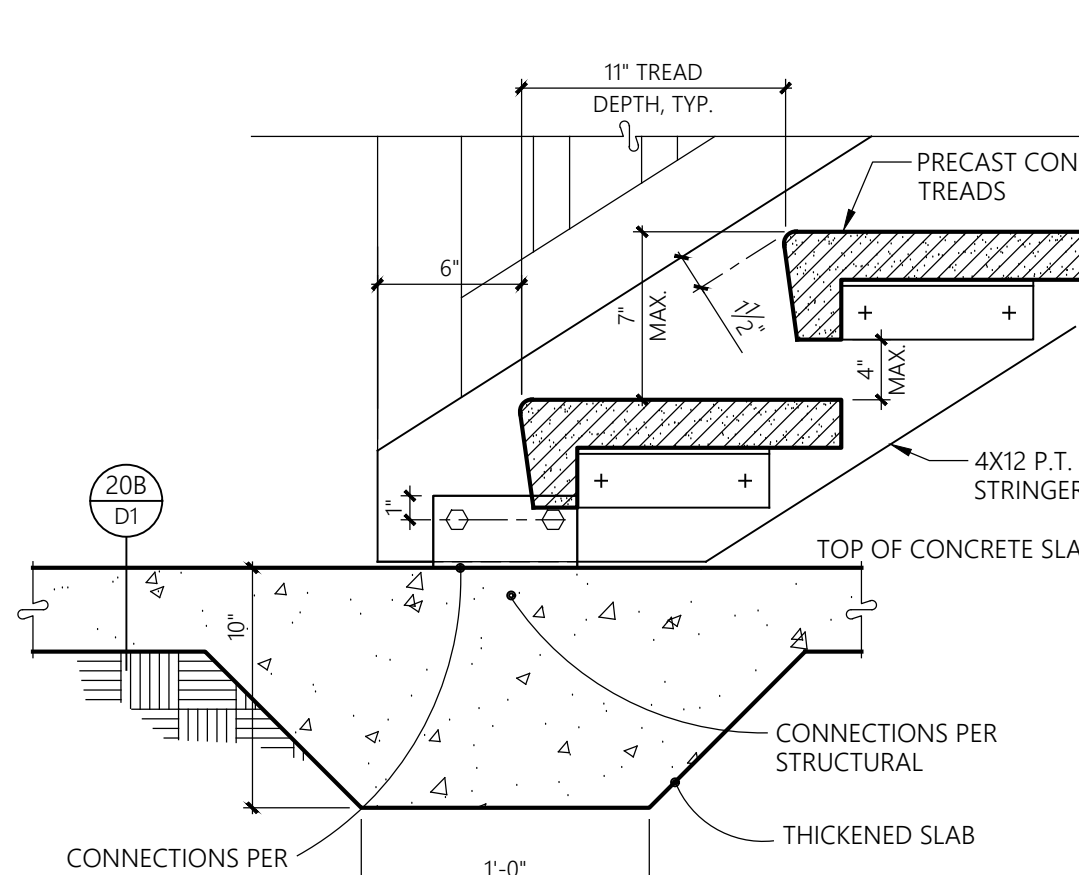


20 STAIR AT BASE
SECTION
1-1/2" = 1'-0"

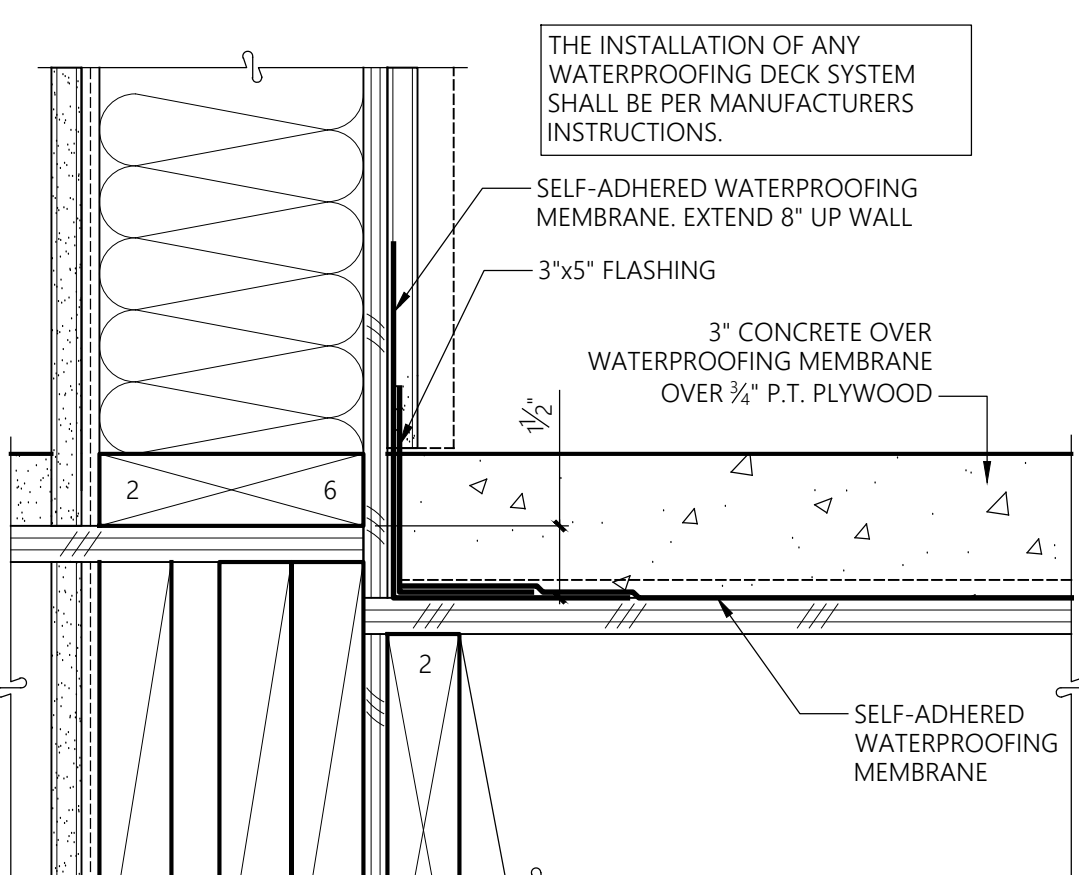


















16 STAIR FLOOR
SECTION
3" = 1'-0"

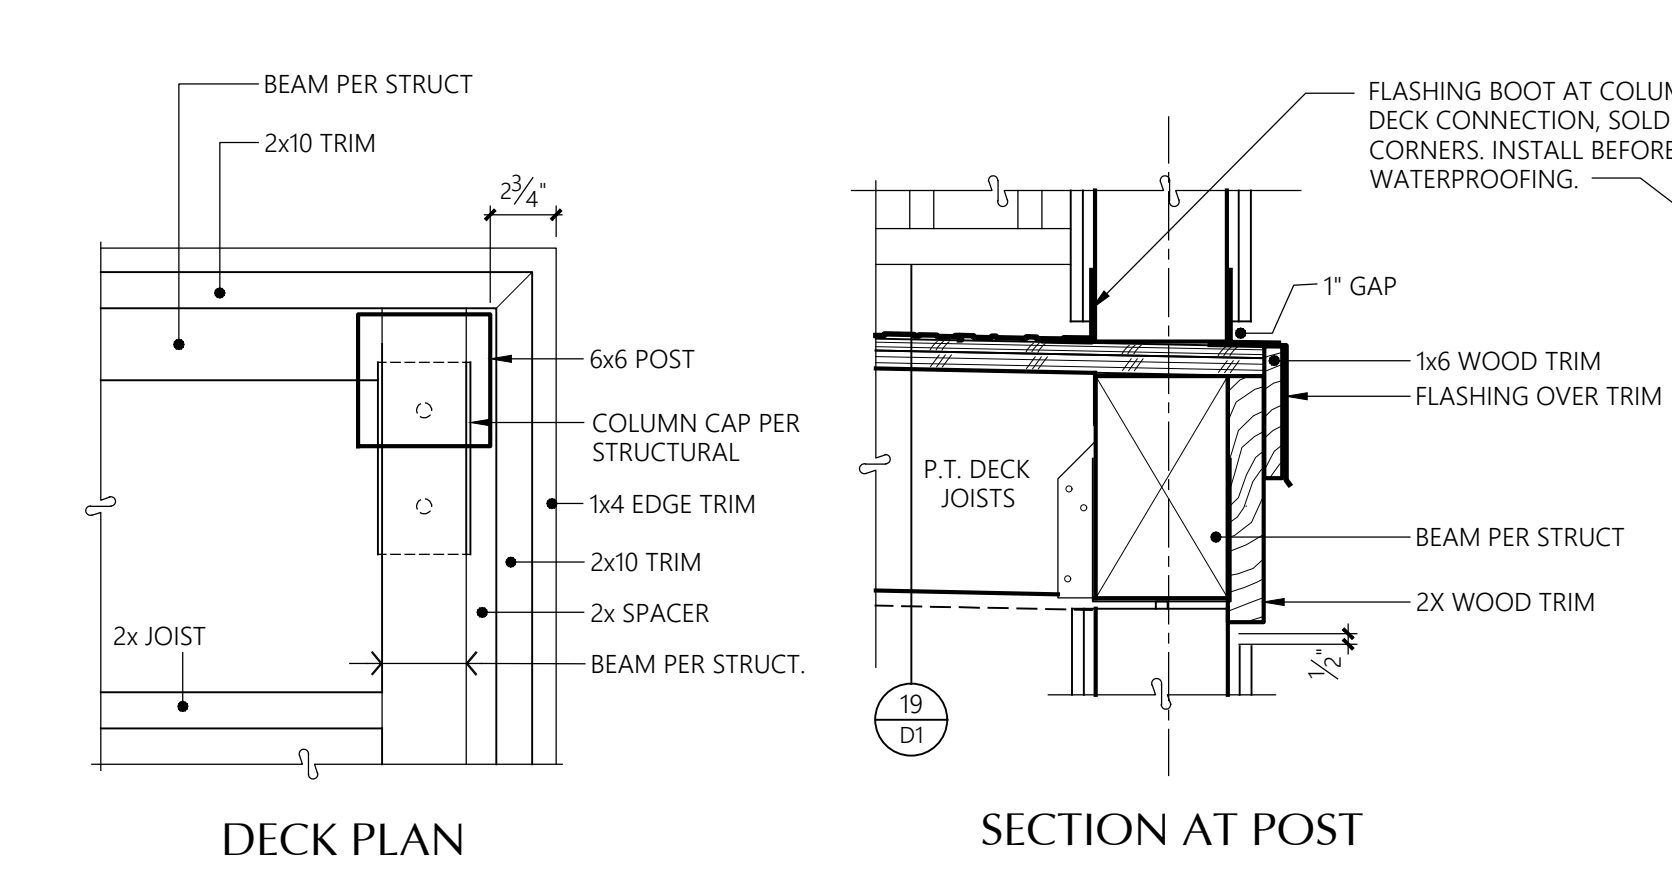


12 POST AT DECK
SECTION
1-1/2" = 1'-0"

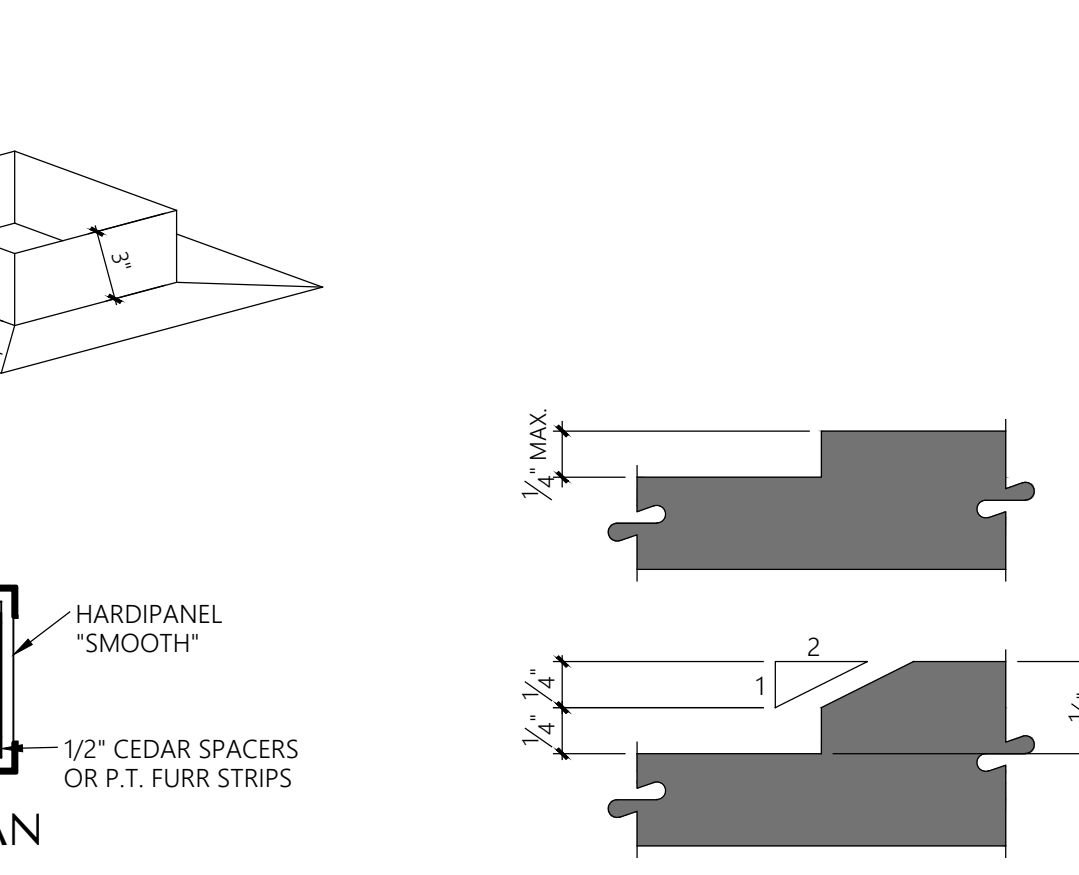

4 DOOR CHANGES IN LEVEL
SECTION
1" = 1'-0"

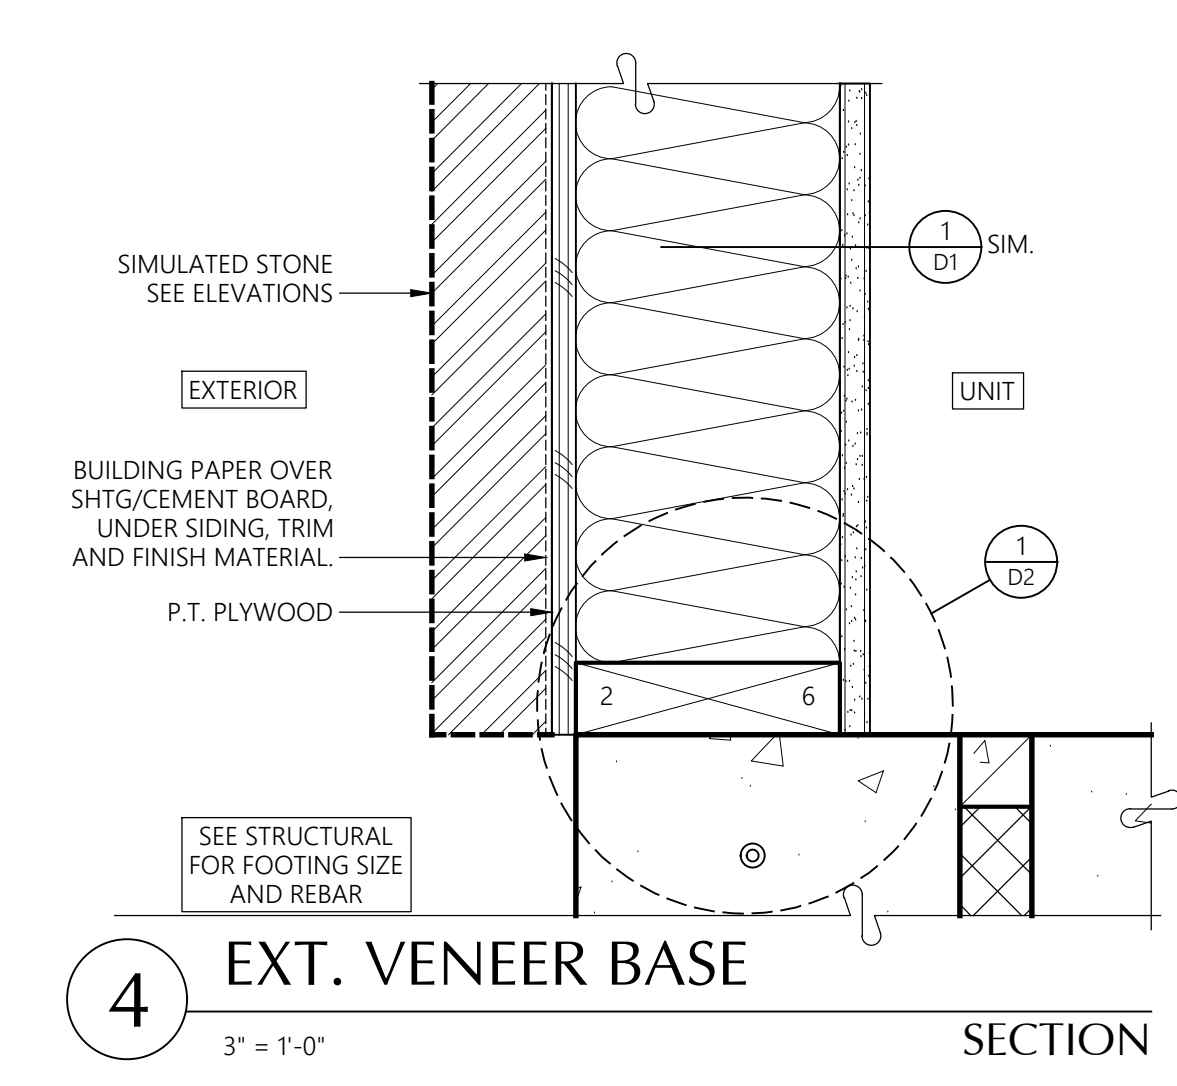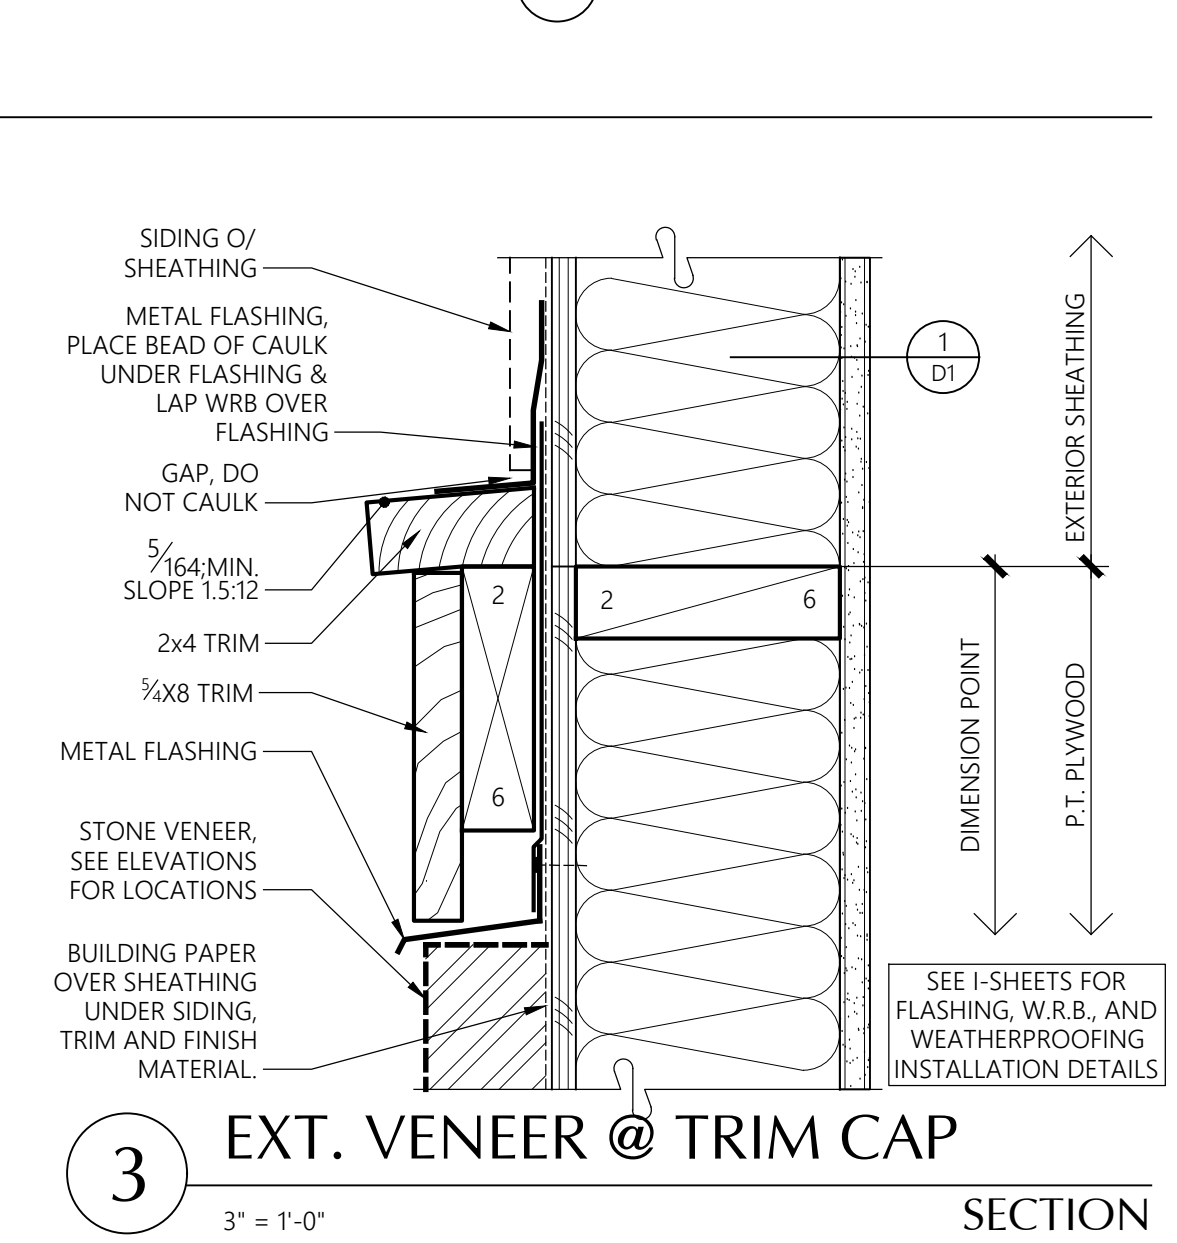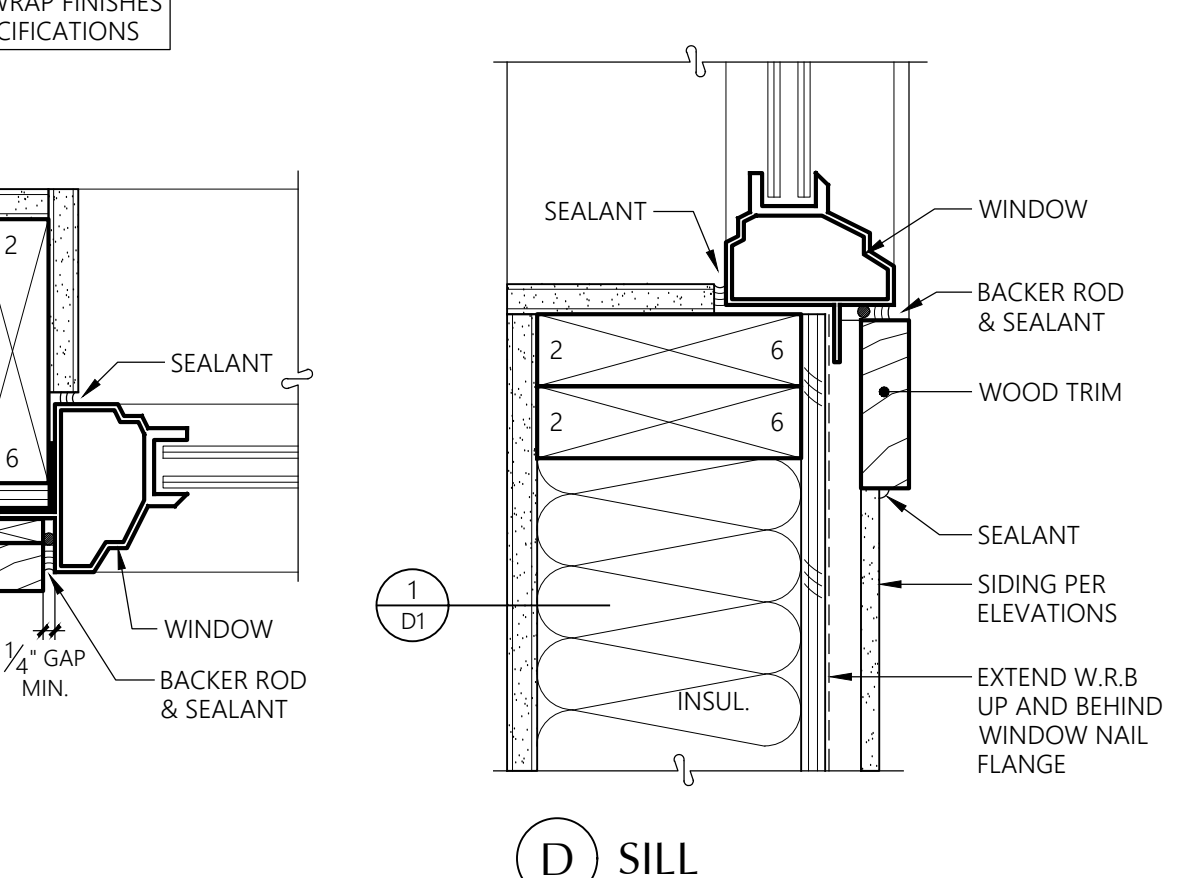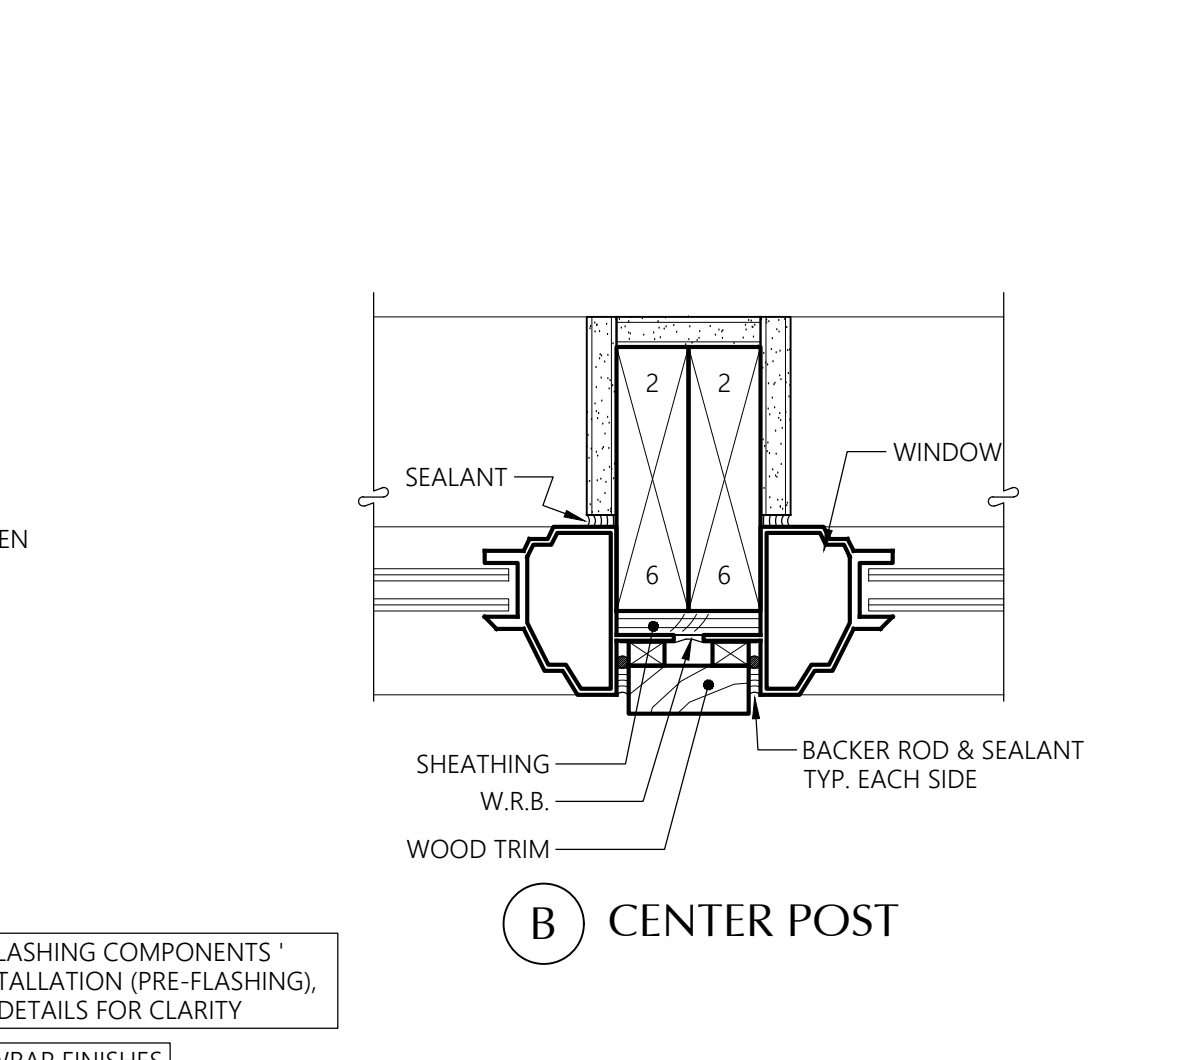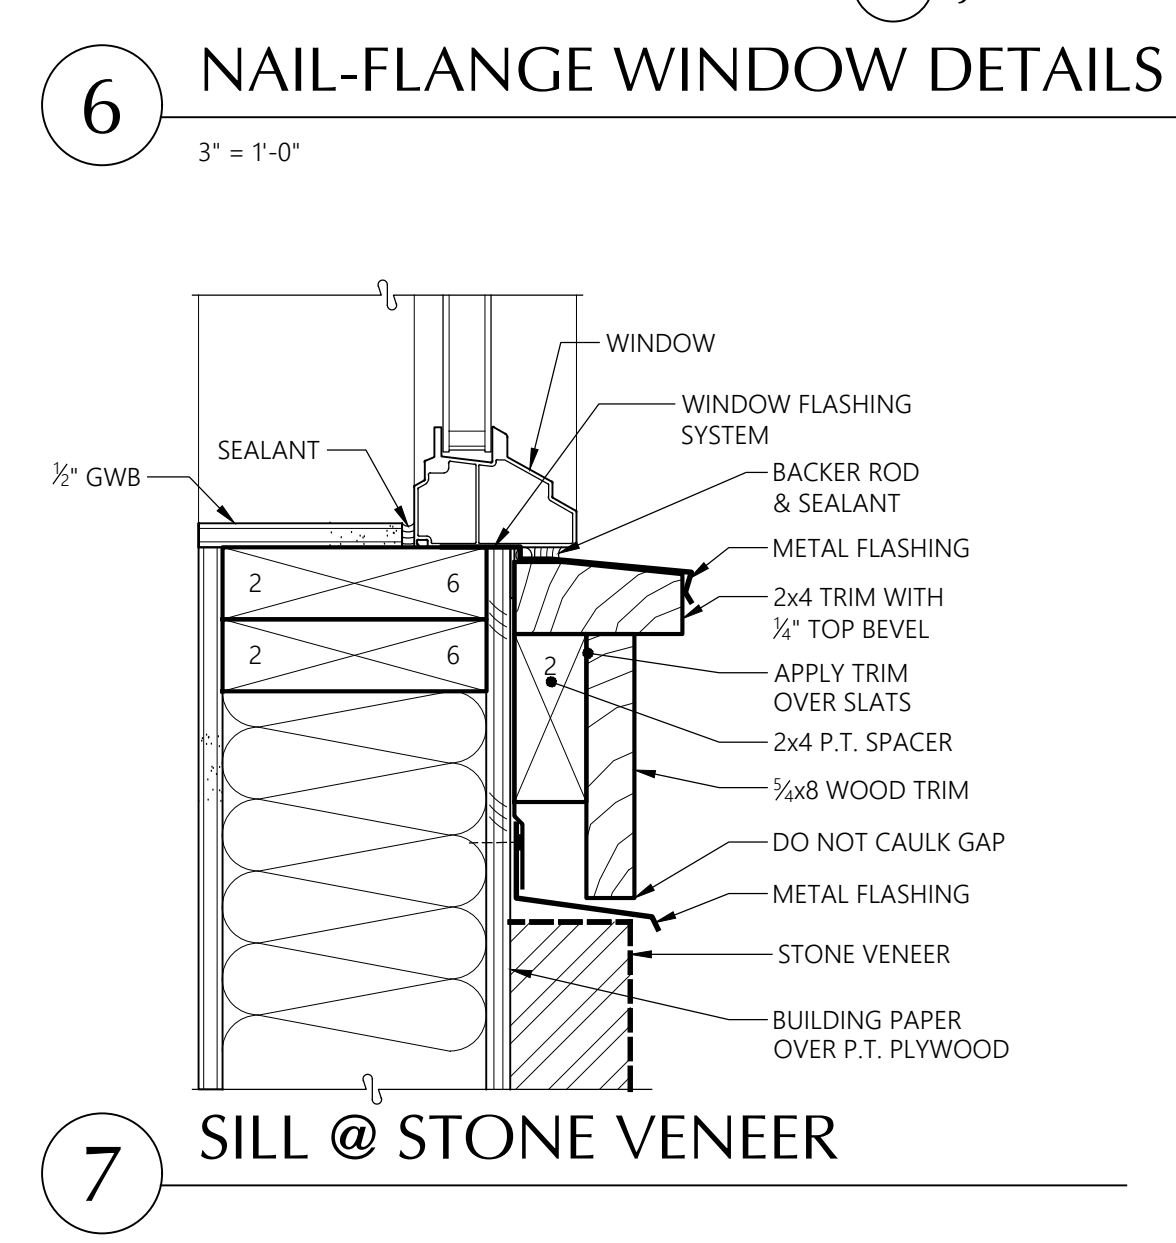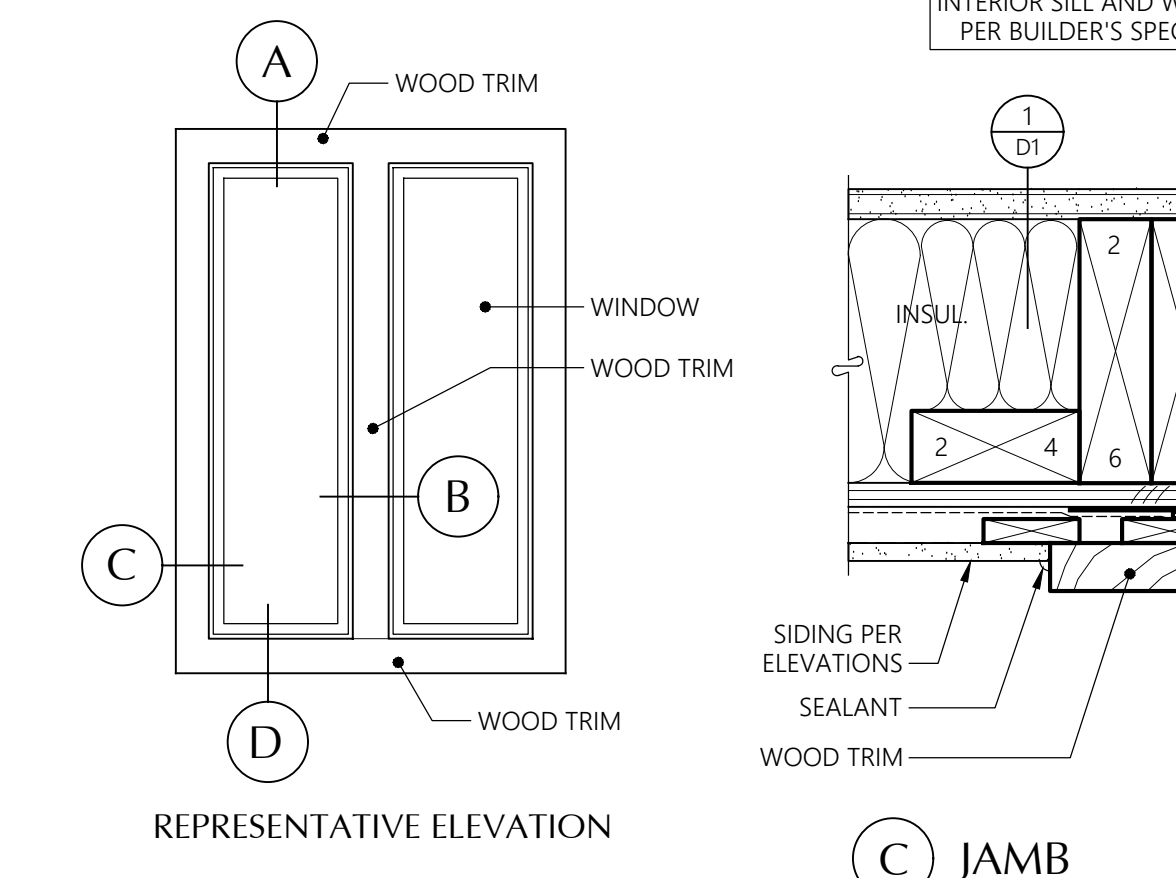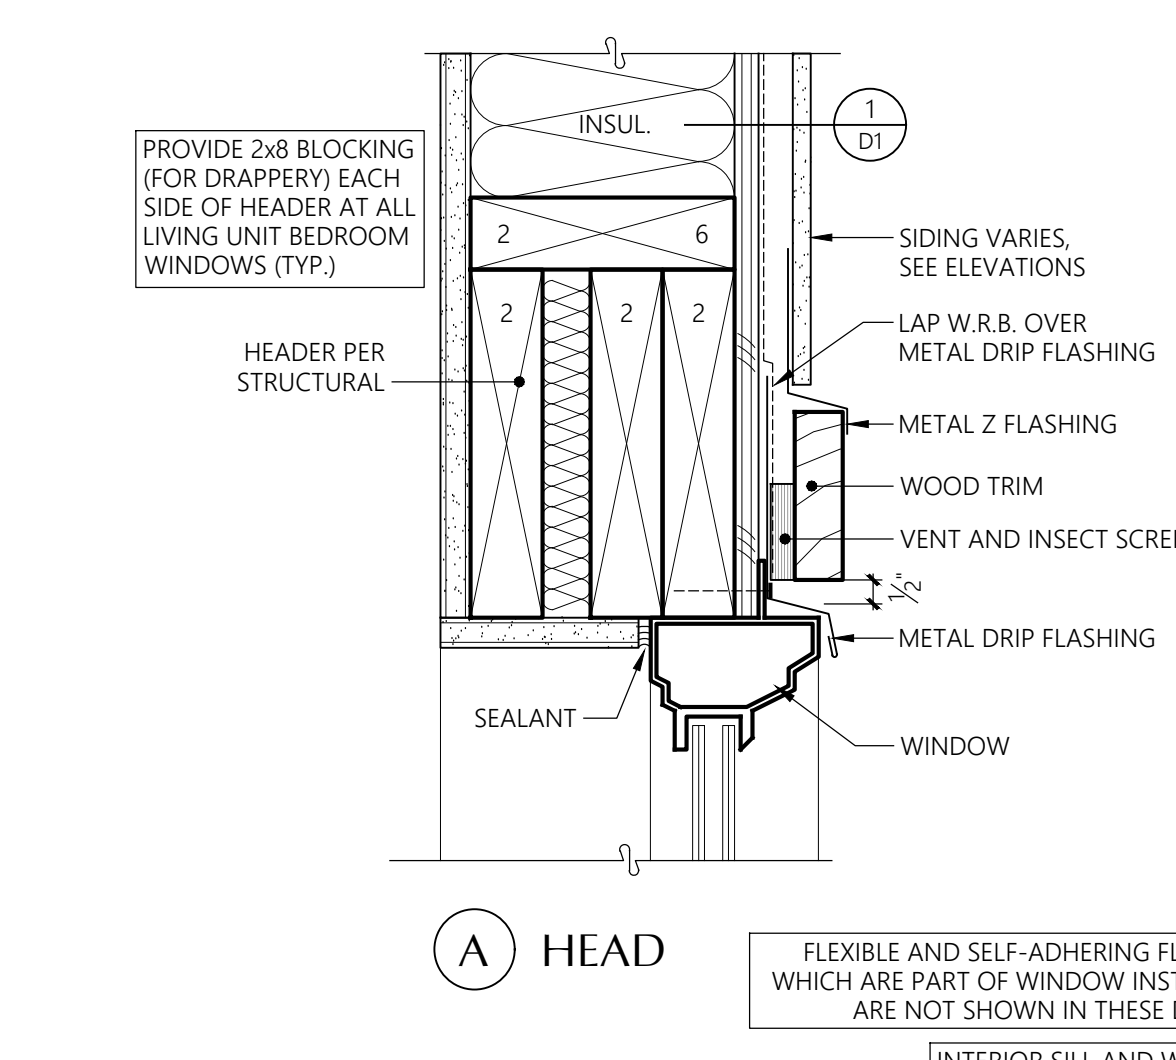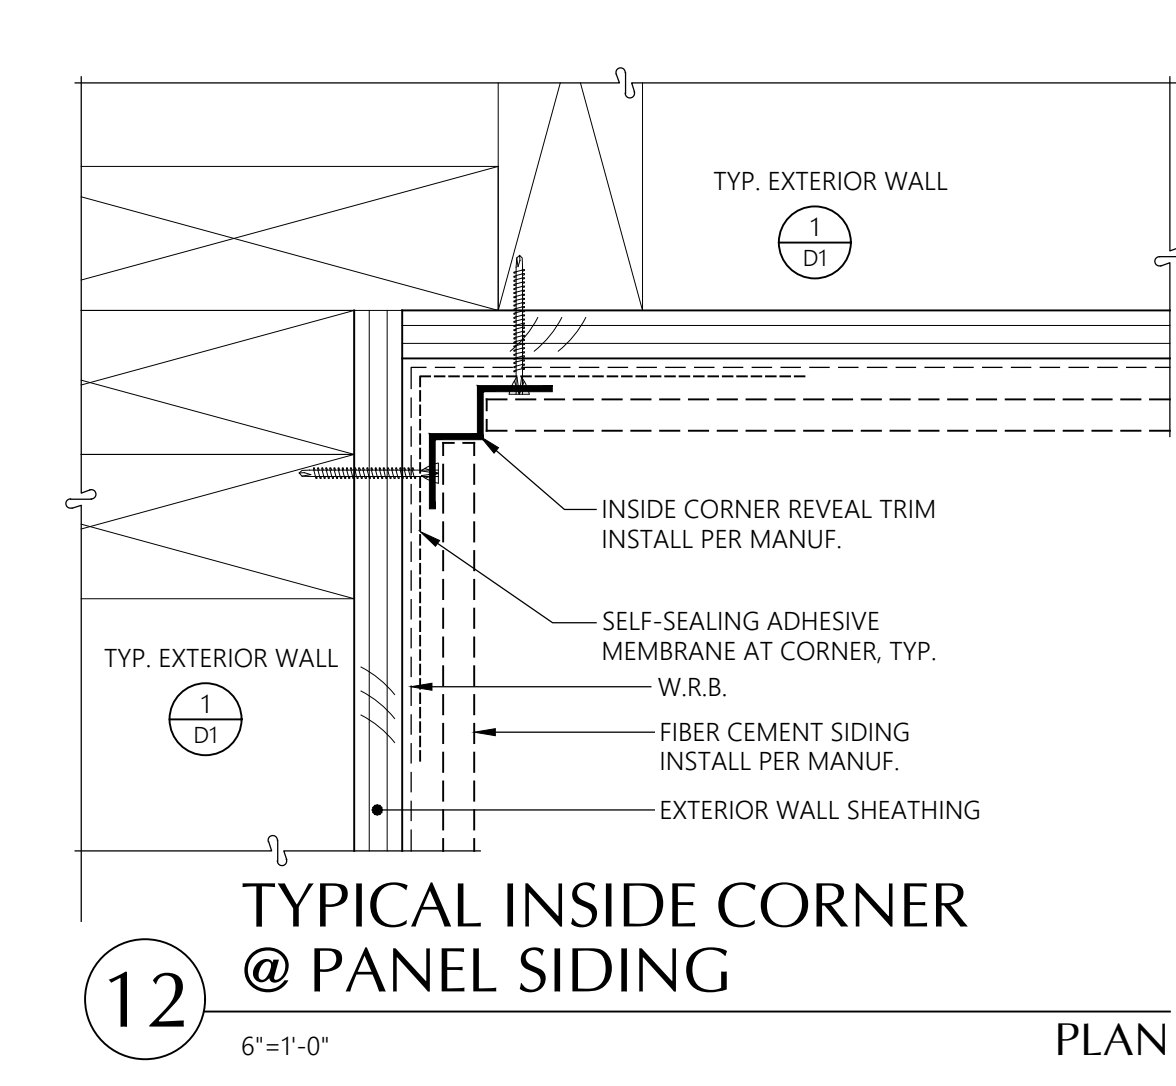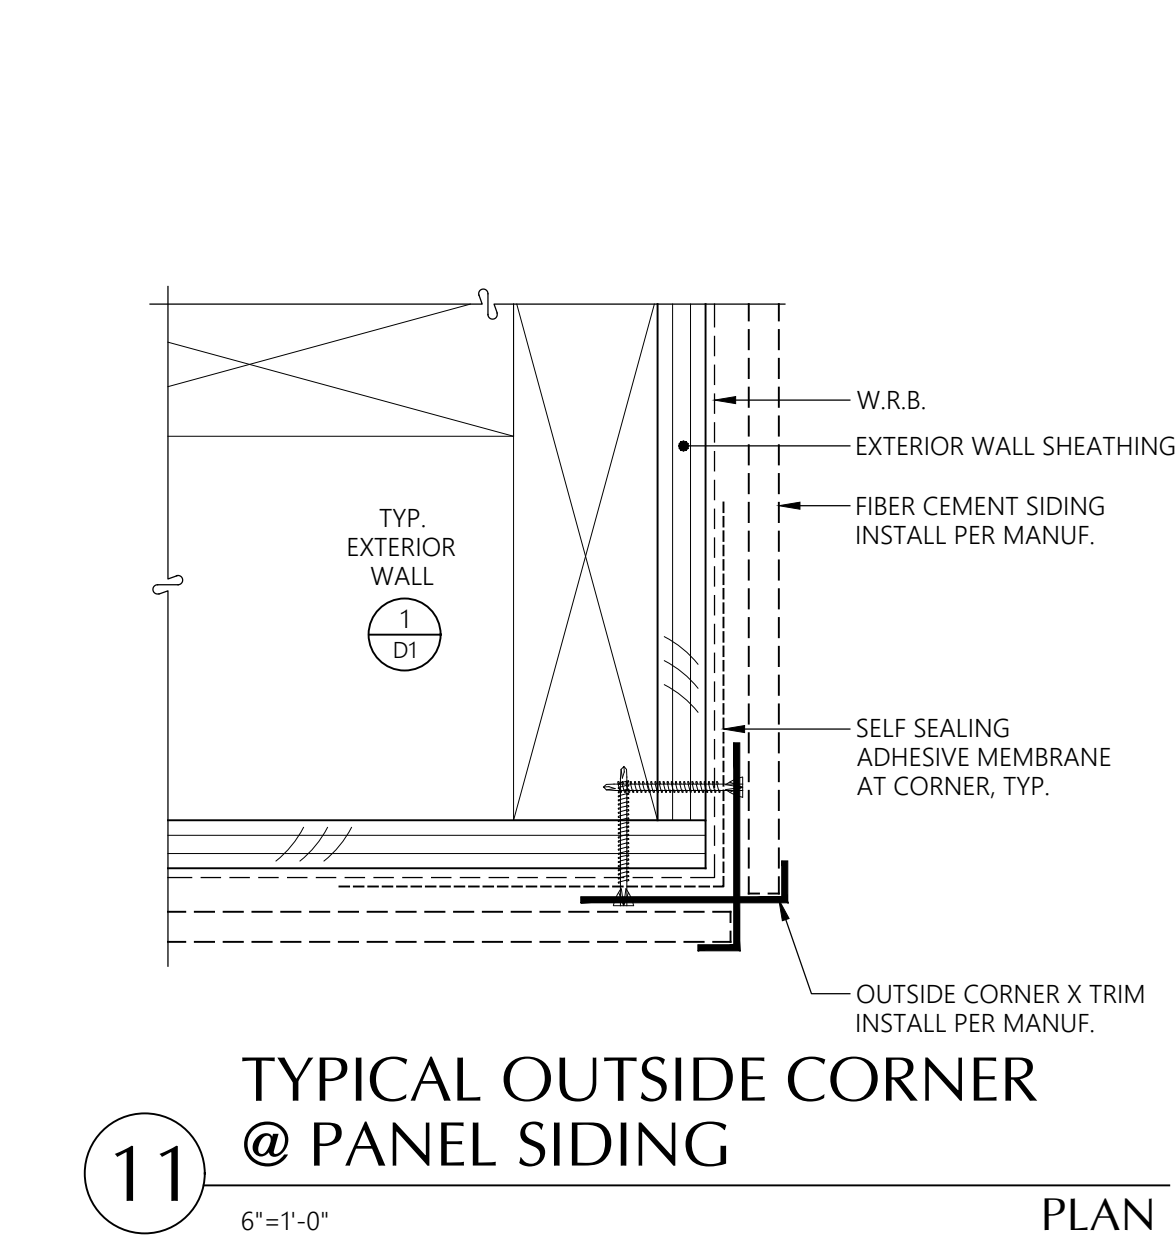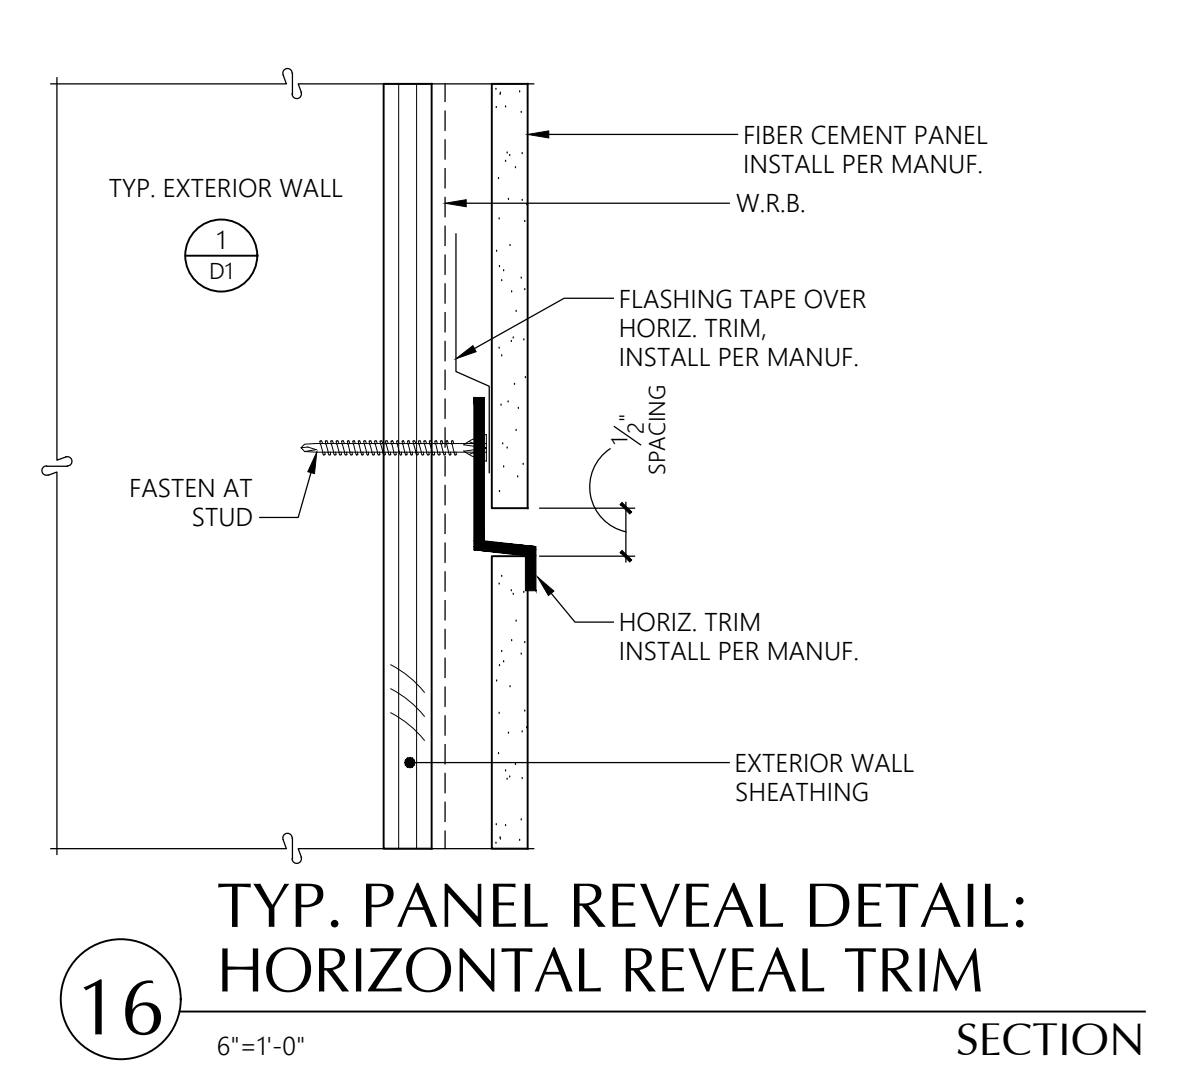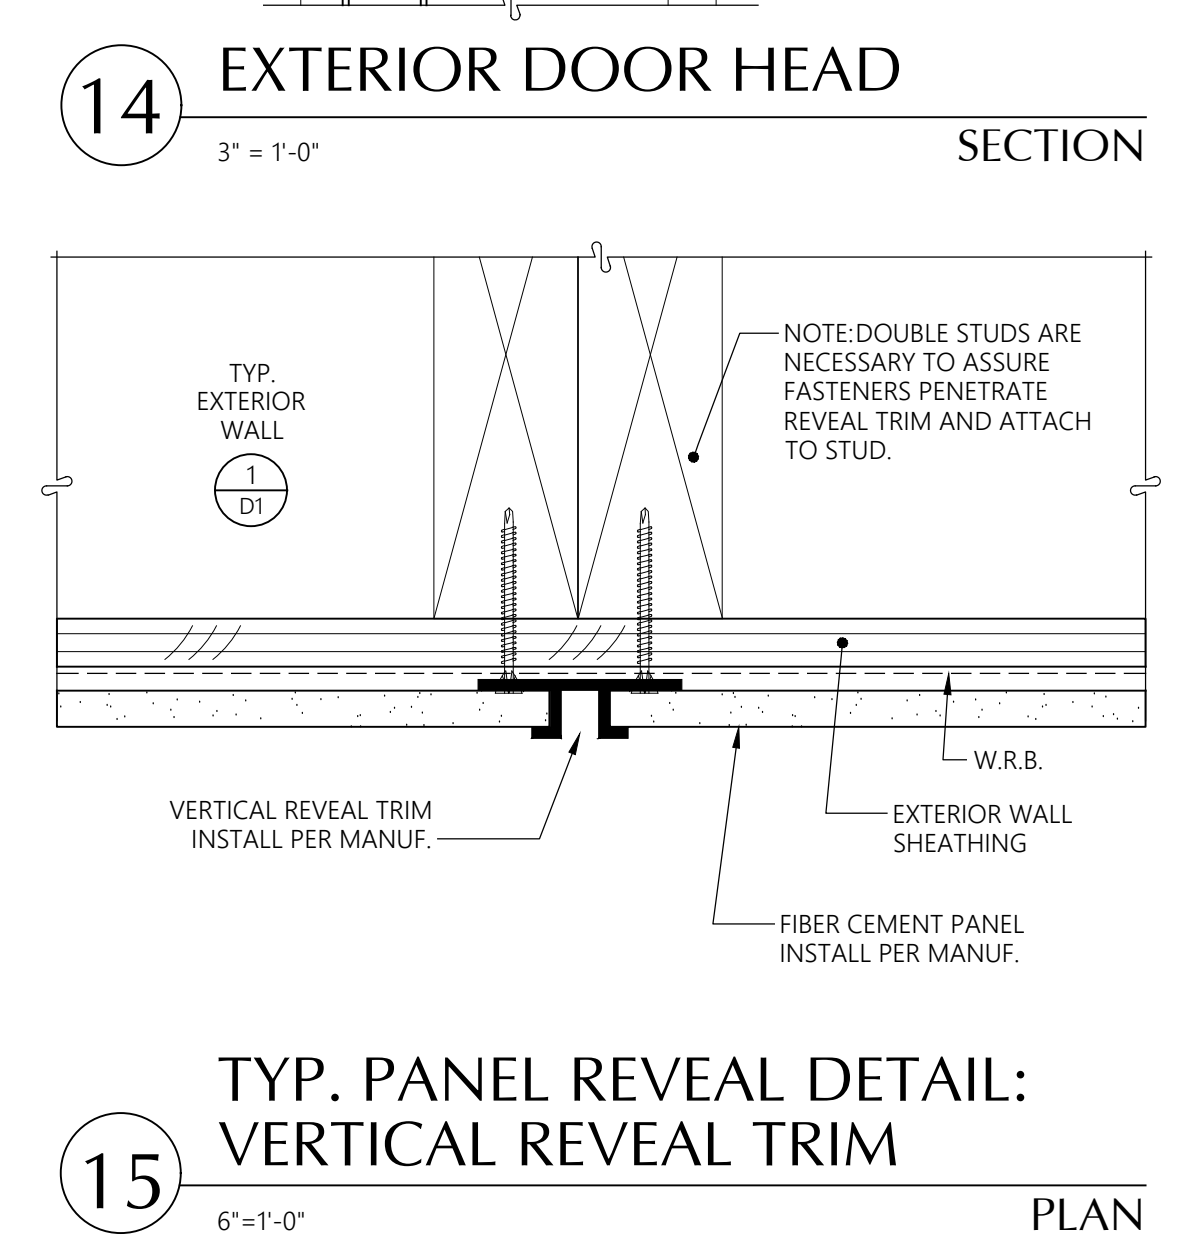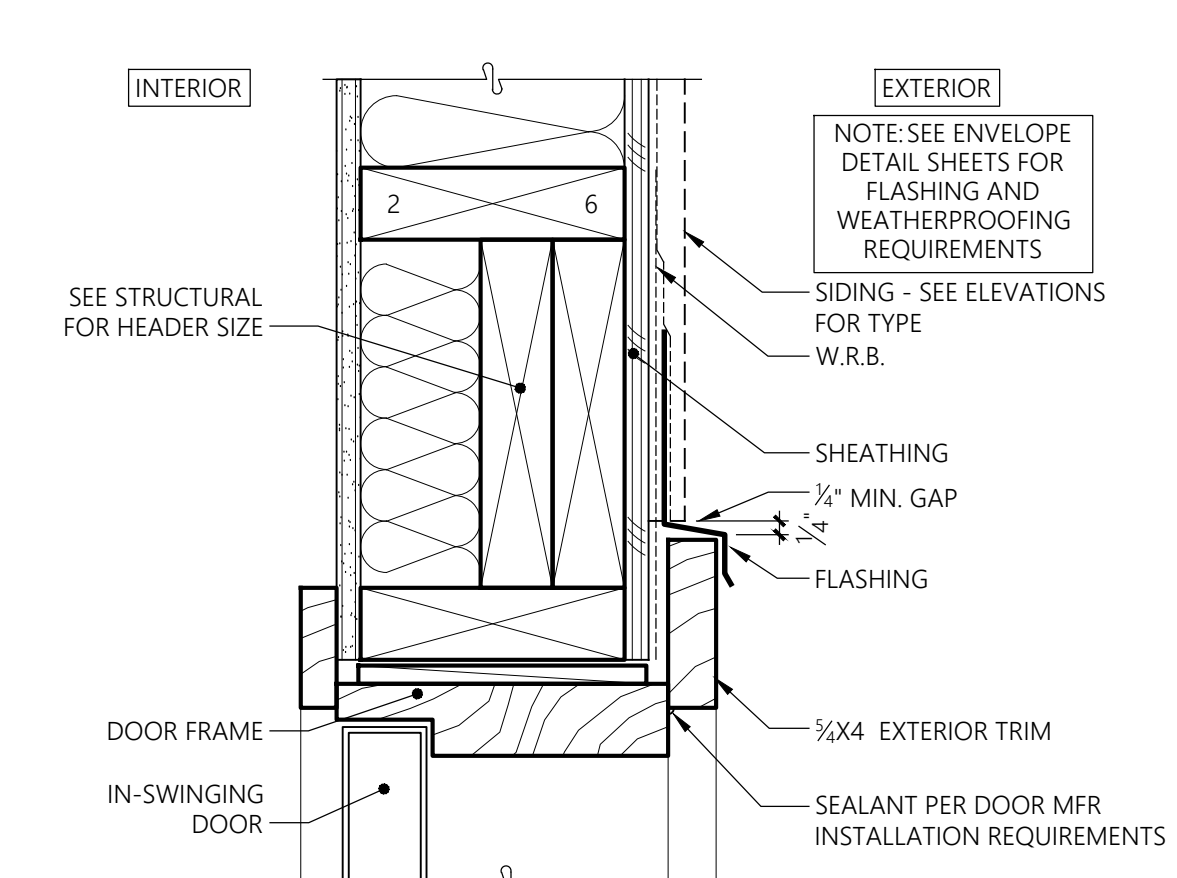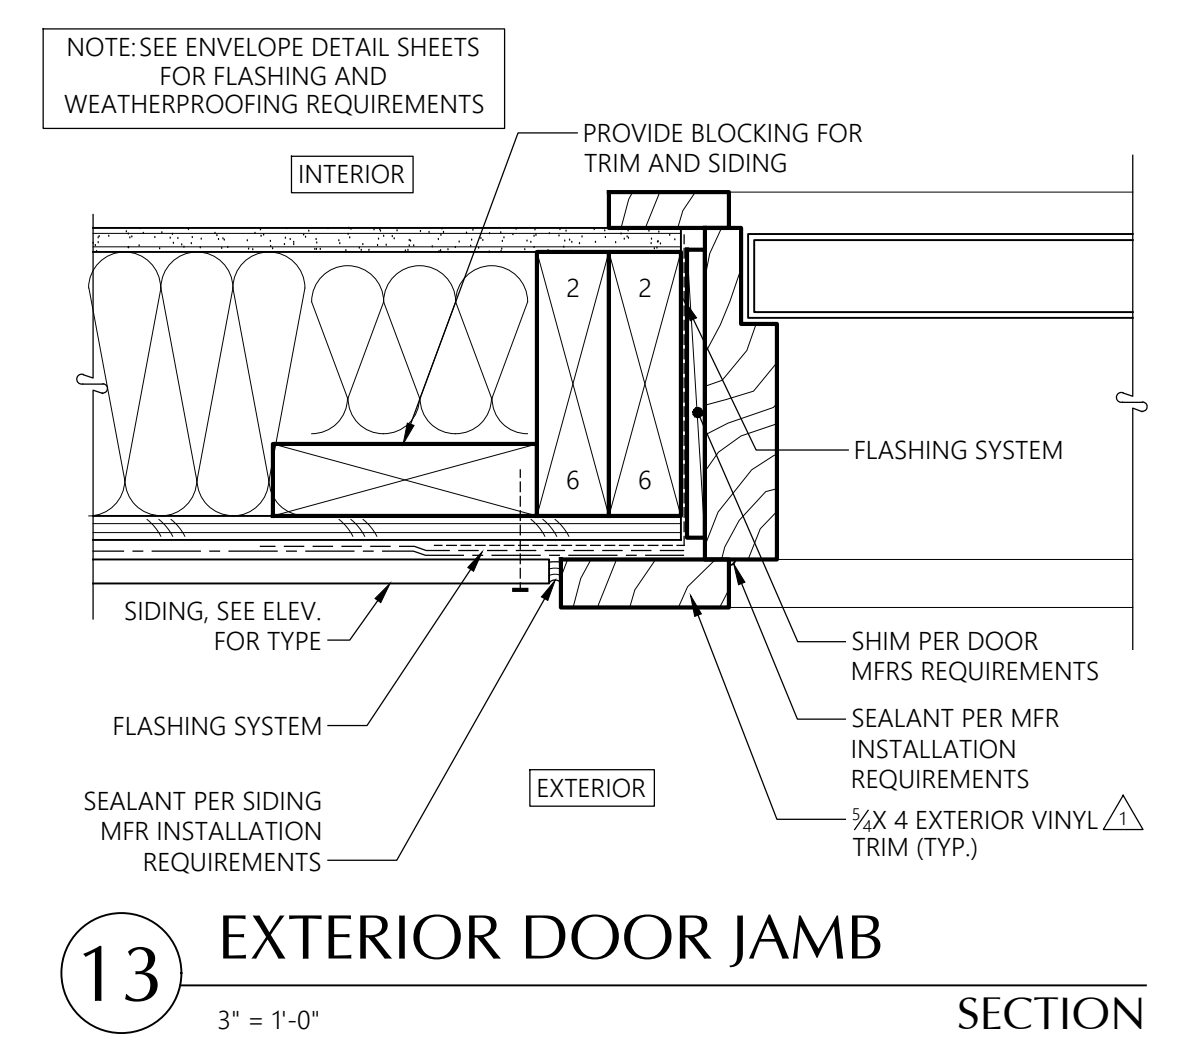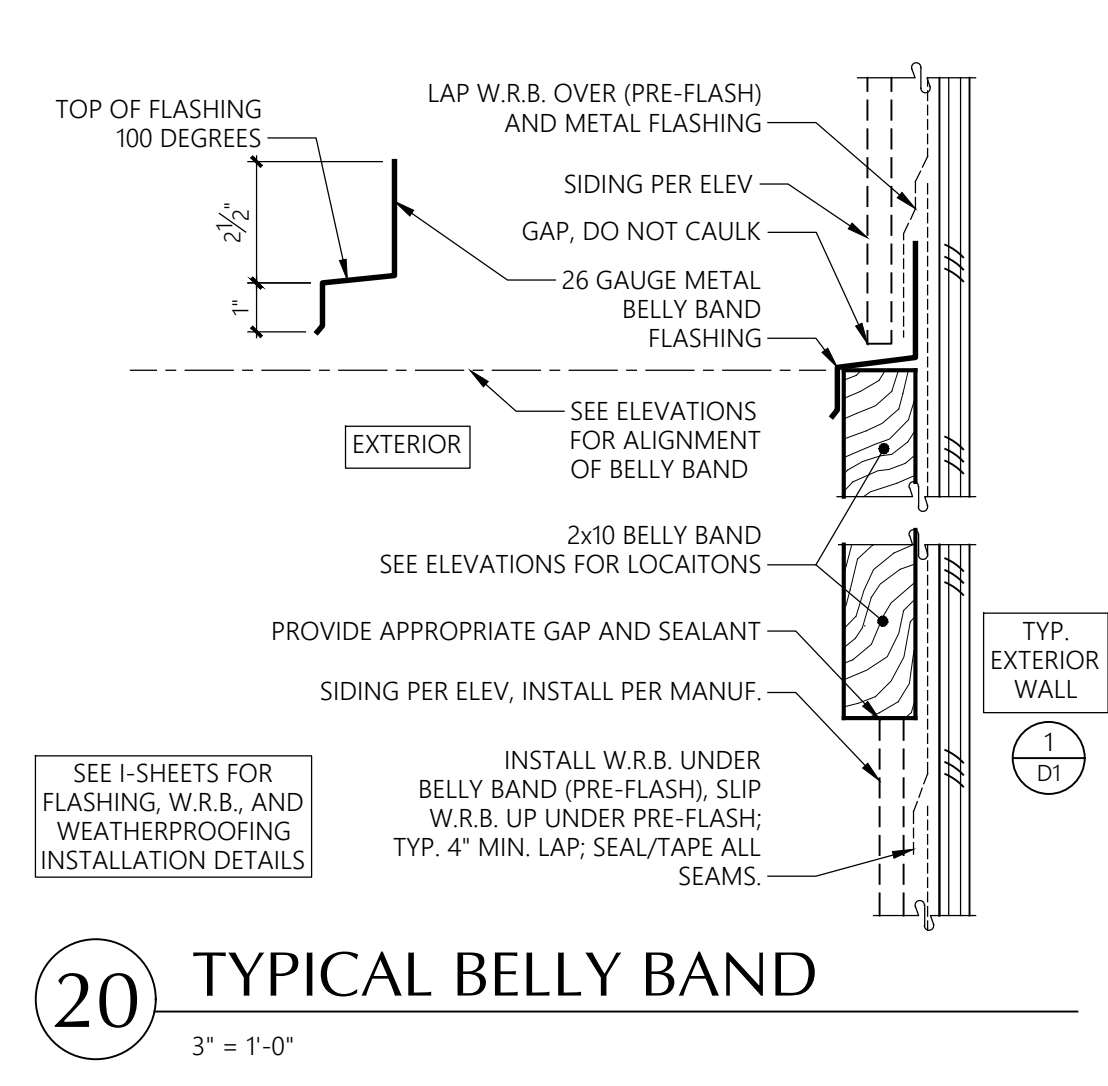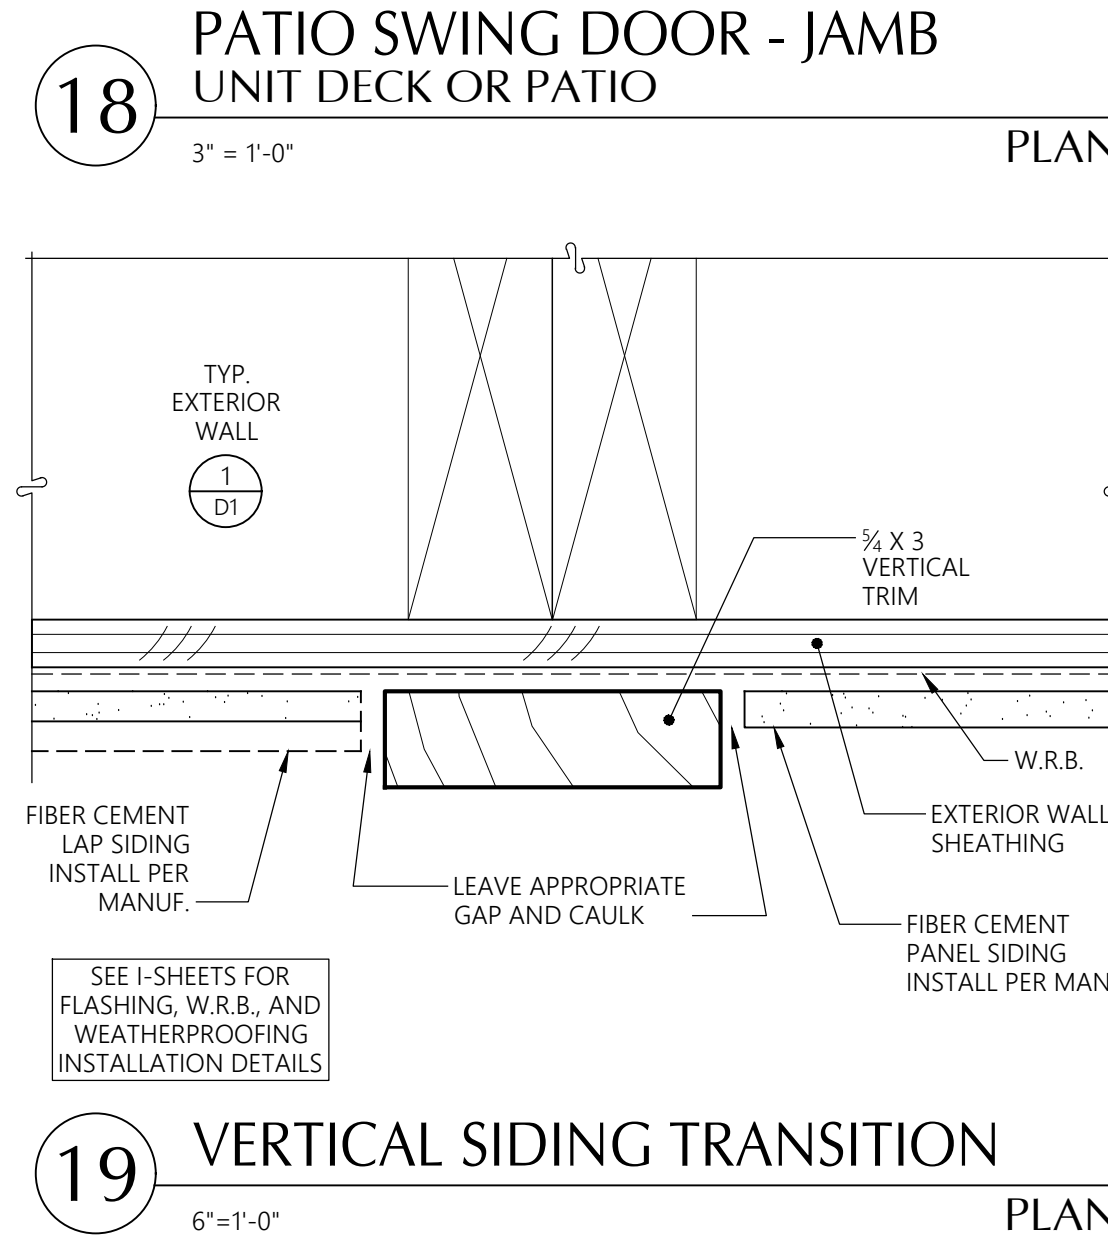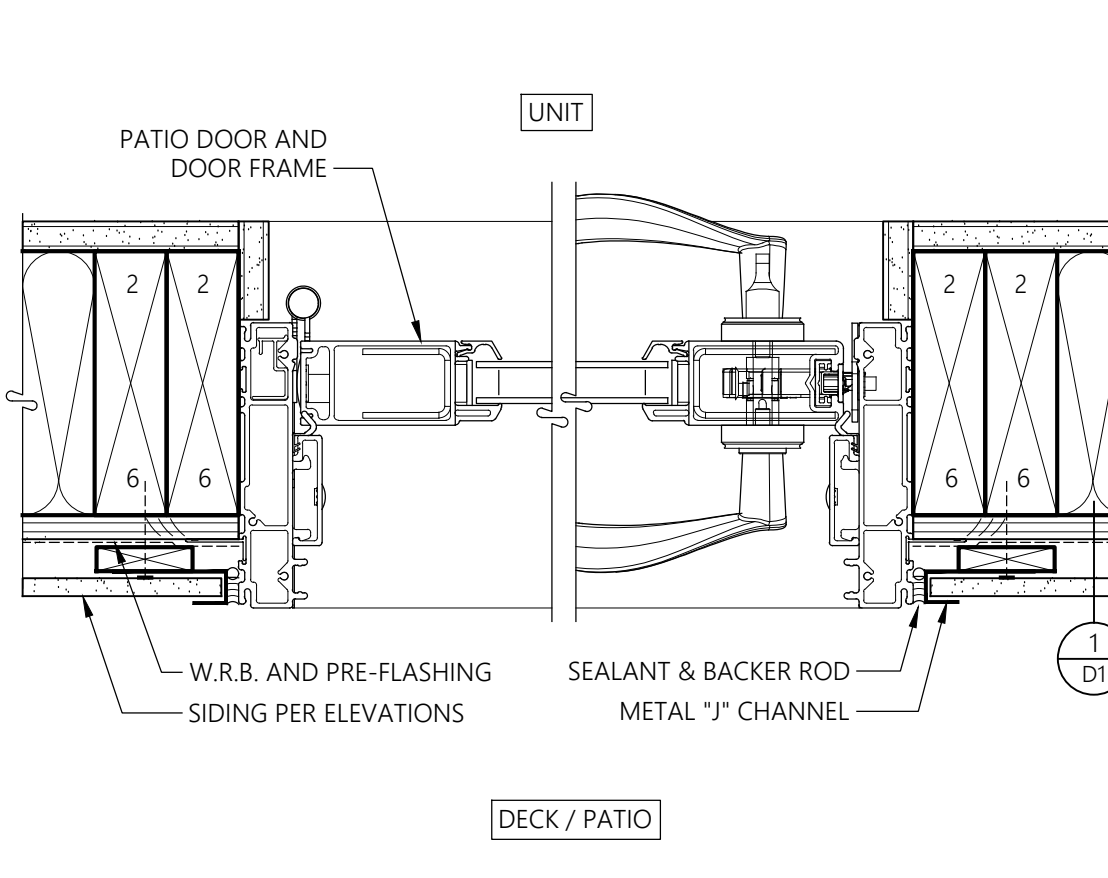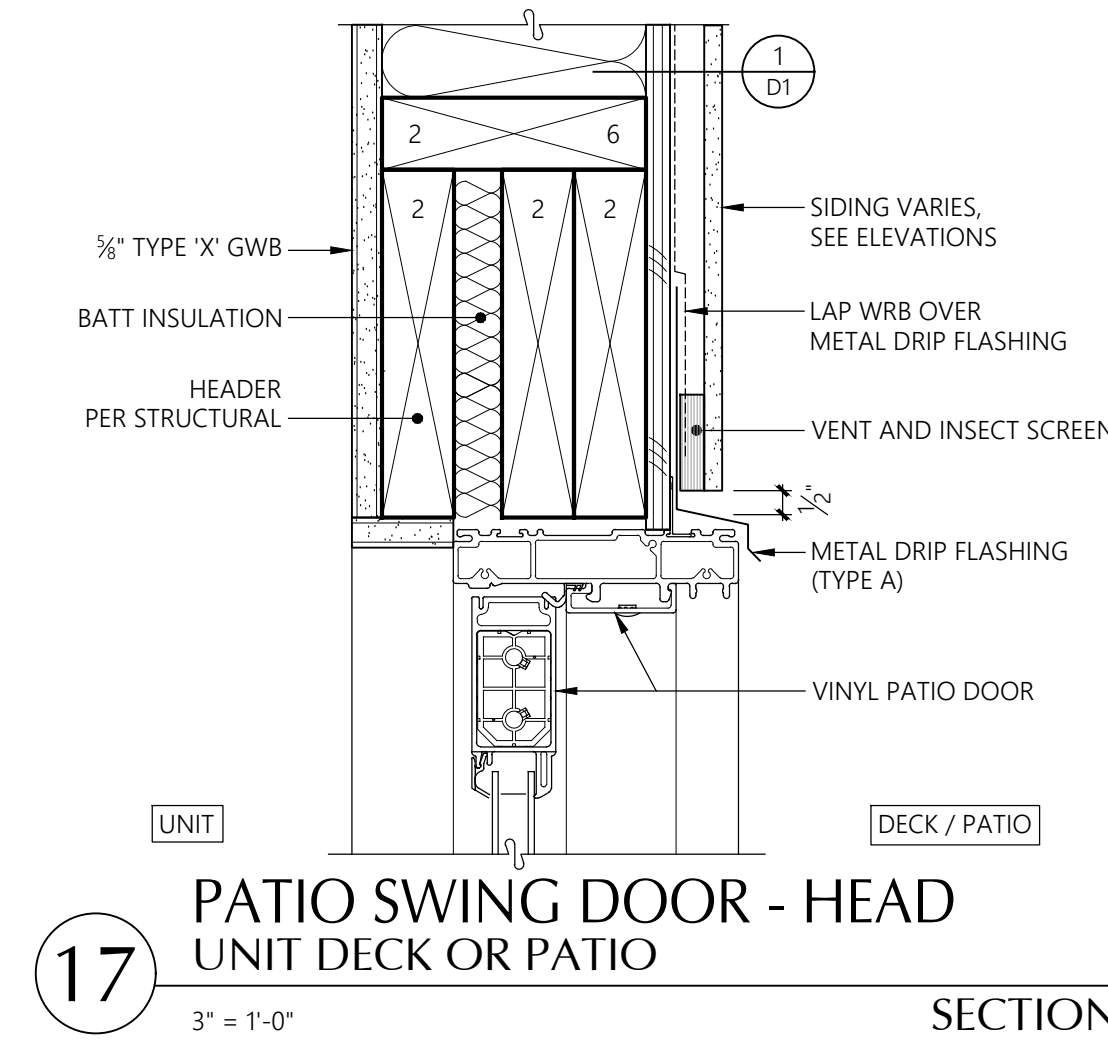

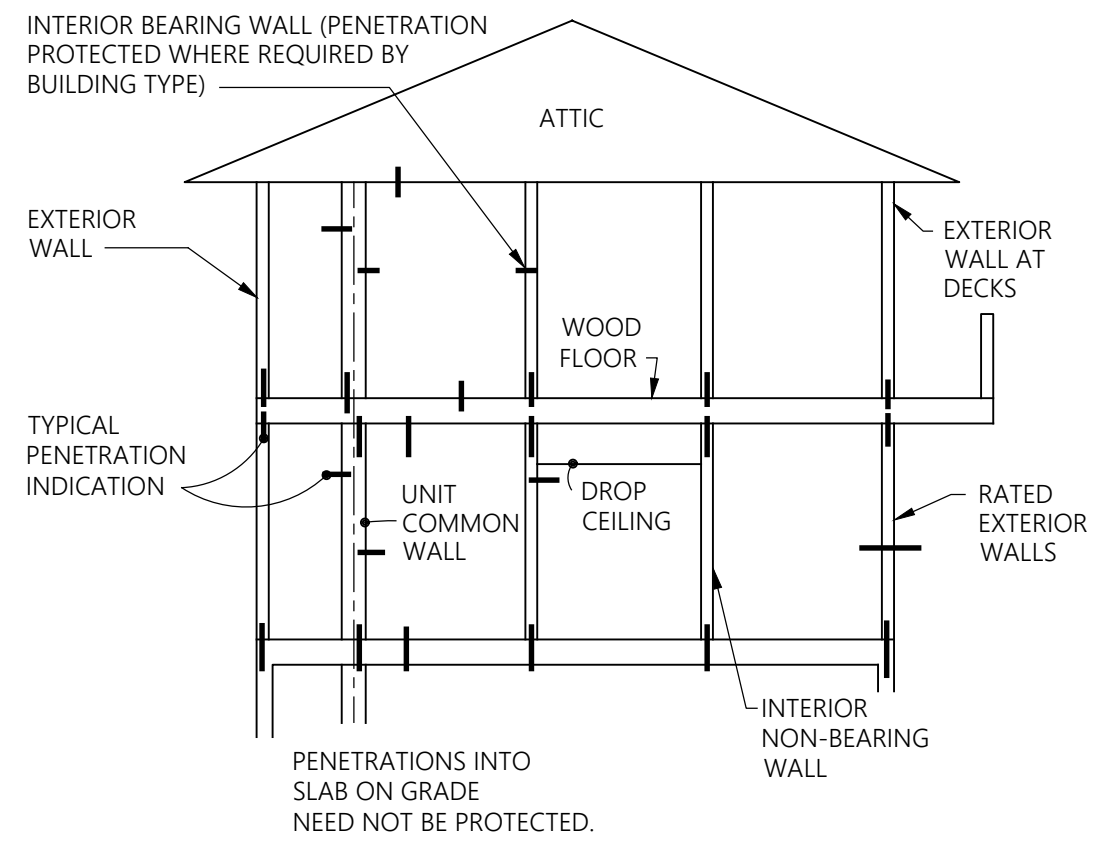

THE PURPOSE OF THIS DETAIL IS TO INDICATE TYPES OF LOCATIONS OF WALL, CEILING AND FLOOR PENETRATIONS THAT NEED TO BE FIRESTOPPED IN ACCORDANCE WITH 706, 708, 711, 713, 714 AND 717 OF THE 2018 INTERNATIONAL BUILDING CODE. THE THICK LINES IN THE DETAIL INDICATE A PENETRATION BY A PIPE, CONDUIT, VENT, ETC., WHETHER PLASTIC (COMBUSTIBLE) OR NON-COMBUSTIBLE. IN GENERAL THESE PENETRATIONS (OR THE ANNULAR SPACE AROUND THEM) WOULD COMPROMISE THE INTEGRITY OF THE FIRE-RATED ASSEMBLY UNLESS IT WERE CLOSED OFF AND PROTECTED DURING A FIRE. COMMON WALLS BETWEEN UNITS ARE FIRE-RATED WALLS. UNRATED WALLS WITHIN UNITS (EVEN THOUGH THEY MAY HAVE RATED WALLBOARD) NEED NOT BE PROTECTED. HOWEVER, PENETRATION OF THE TOP AND BOTTOM PLATES OF UNRATED WALLS INTO THE RATED FLOOR ASSEMBLY NEEDS TO BE FIRESTOPPED. THE CONTRACTOR SHALL DETERMINE FIRESTOPPING FOR EACH SITUATION, AND TESTED ASSEMBLIES SHALL BE SUBMITTED TO THE ARCHITECT AND THE CITY IN ACCORDANCE WITH THE "DEFERRED SUBMITTALS" SECTION ON THE COVER SHEET.

17 PENETRATION LOCATIONS FOR FIRESTOPPING SECTION
NO SCALE


NOTE: THESE FIRESTOPPING DETAILS ARE REPRESENTATIVE OF TYPICAL SITUATIONS ONLY. FOR OTHER CONDITIONS REFER TO 3M MATRIX OF UL TESTED SYSTEMS BELOW. IF CONDITION IS NOT COVERED IN THIS MATRIX, CONTACT MANUFACTURER FOR TESTED ASSEMBLY RECOMMENDATION. ALL FIRESTOP DETAILS TO BE EXECUTED BY LICENSED AND/OR CERTIFIED INSTALLER.

FIRESTOPPING PENETRATIONS AND VOIDS IN RATED CONSTRUCTION: MATRIX OF UL TESTED SYSTEMS:


PENETRATING ITEM	ASSEMBLY	FIRE RATING	SYSTEM	PRODUCT	PENETRATING ITEM	ASSEMBLY	FIRE RATING	SYSTEM	PRODUCT
METAL PIPE/CONDUIT	CONC. WALLS/FLRS	2,3,8,4 HR	CAJ1044	CP25WB+	PLASTIC PIPE	CONC. WALLS/FLRS	182 HR	CAJ2001	*PPD
MULTIPLE METAL	CONC. WALLS/FLRS	2 HR	CAJ1092	CP25WB+	PLASTIC PIPE	GYP. WALLS	182 HR	WL2002	*PPD
METAL PIPE/CONDUIT	GYP. WALLS	1,2&3 HR	WL1001	CP25WB+	PLAS. JACKETED CABLE	CONC. WALLS/FLRS	2 HR	CAJ3021	MOLDABLE PUTTY
MULTIPLE METAL	GYP. WALLS	1&2 HR	WL1016	CP25WB+	PLAS. JACKETED CABLE	GYP. WALLS	182 HR	WL3031	MOLDABLE PUTTY
INSULATED PIPE	CONC. WALLS/FLRS	1,2,8,3 HR	CAJ5001	CP25WB+	CABLE TRAYS	CONC. WALLS/FLRS	2&3 HR	CAJ4003	CP25WB+ CS195+
INSULATED PIPE	GYP. WALLS	1&2 HR	WL5039	CP25WB+	CABLE TRAYS	GYP. WALLS	182 HR	WL4004	CP25WB+ CS195+
HVAC DUCTS (RECT.)	CONC. WALLS/FLRS	2 HR	CAJ7016	CP25WB+	BUS DUCT	CONC. WALLS/FLRS	2&3 HR	CAJ6001	CP25WB+ CS195+
HVAC DUCTS (ROUND)	CONC. WALLS/FLRS	2 HR	CAJ7003	CP25WB+	ELEC. OUTLET BOXES	GYP. WALLS	182 HR	ANSJ UL263	MOLDABLE PUTTY
HVAC DUCTS	GYP. WALLS	1&2 HR	WL7008	CP25WB+	CONSTRUCTION JOINTS:				
PVDF PLASTIC	CONC. WALLS/FLRS	2 HR	CAJ2121	FS195+ CP25WB+	GYP. WALL TO CONC. DECK	CONC. DECK	182 HR	HW0012	SILICONE 2300
PVDF PLASTIC	GYP. WALLS	1&2 HR	WL2092	FS195+ CP25WB+	CONC. FLOOR TO CONC. FLOOR	CONC. FLOOR	3 HR	FFD1002	SILICONE 2003

*PPD = 3M PLASTIC PIPE DEVICE


18 MATRIX OF UL TESTED SYSTEMS FOR FIRESTOPPING NTS

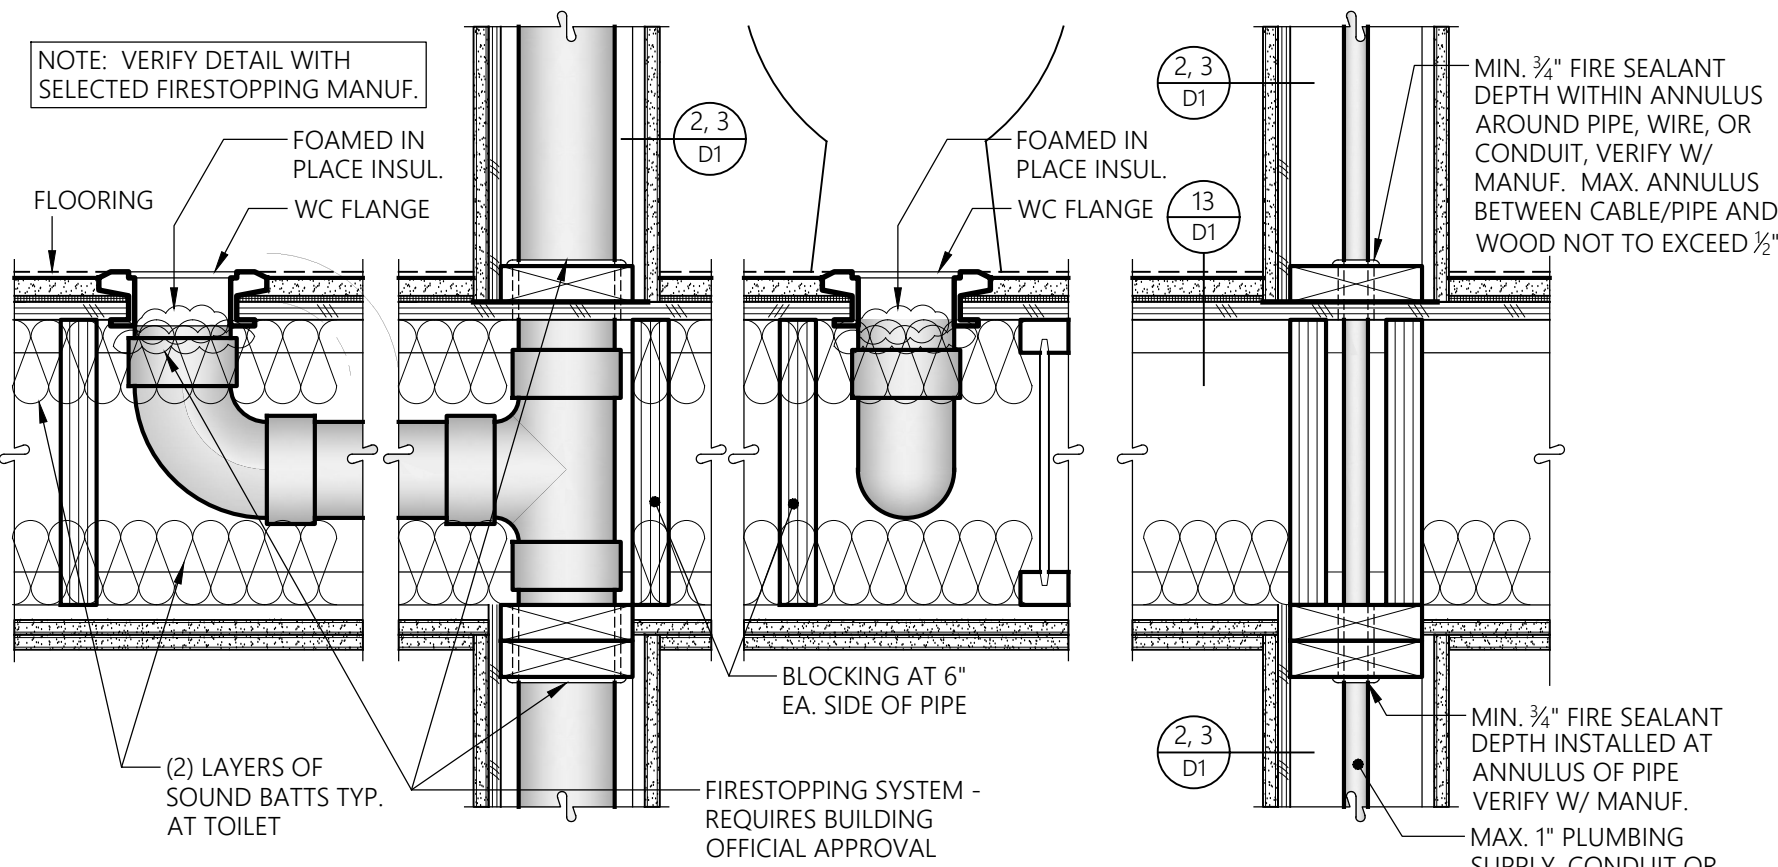


19 TYP. FIRESTOP AT PENETRATION SECTION
1-1/2" = 1'-0"

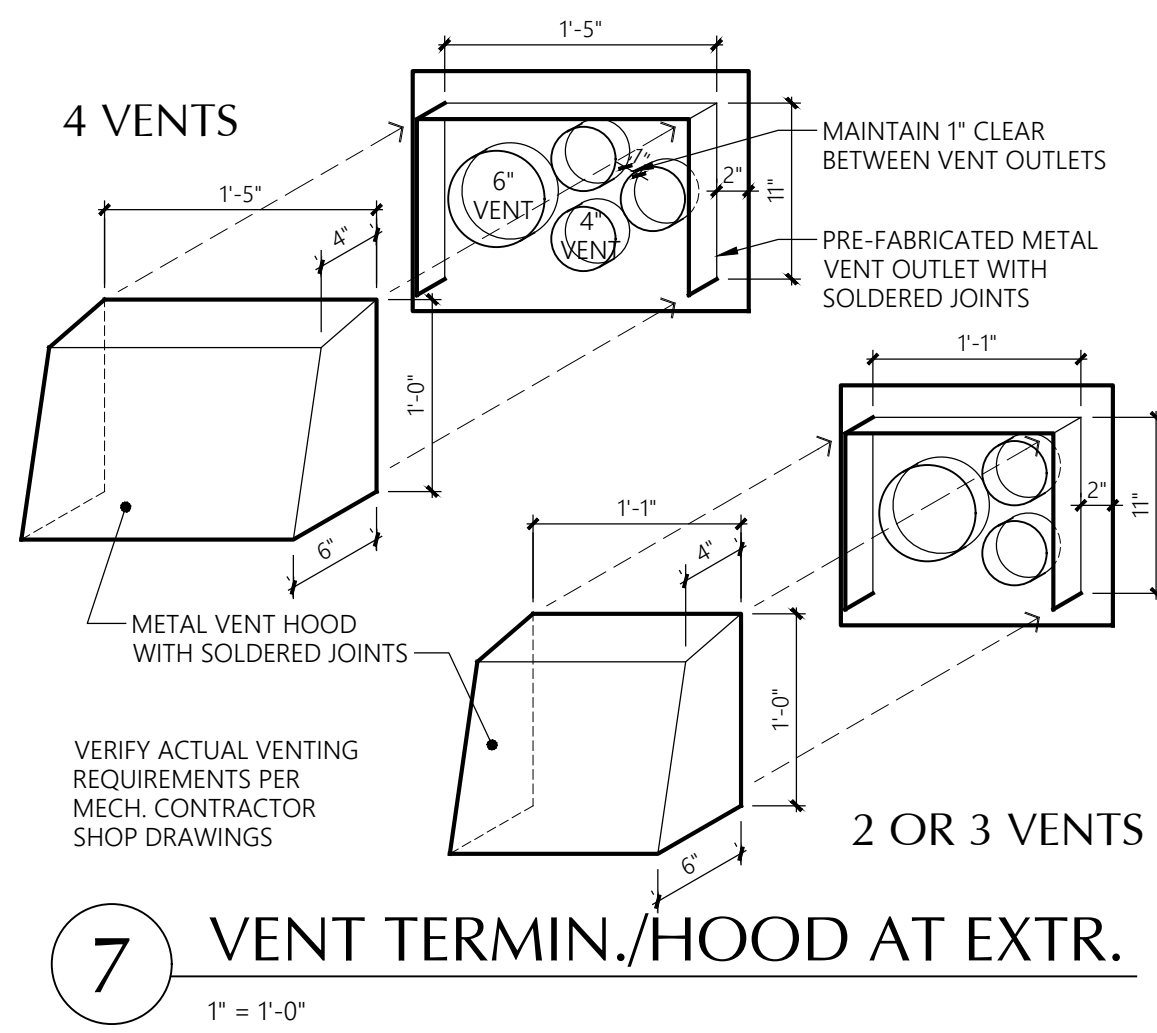

7 VENT TERMIN./HOOD AT EXTR. SECTION
1" = 1'-0"

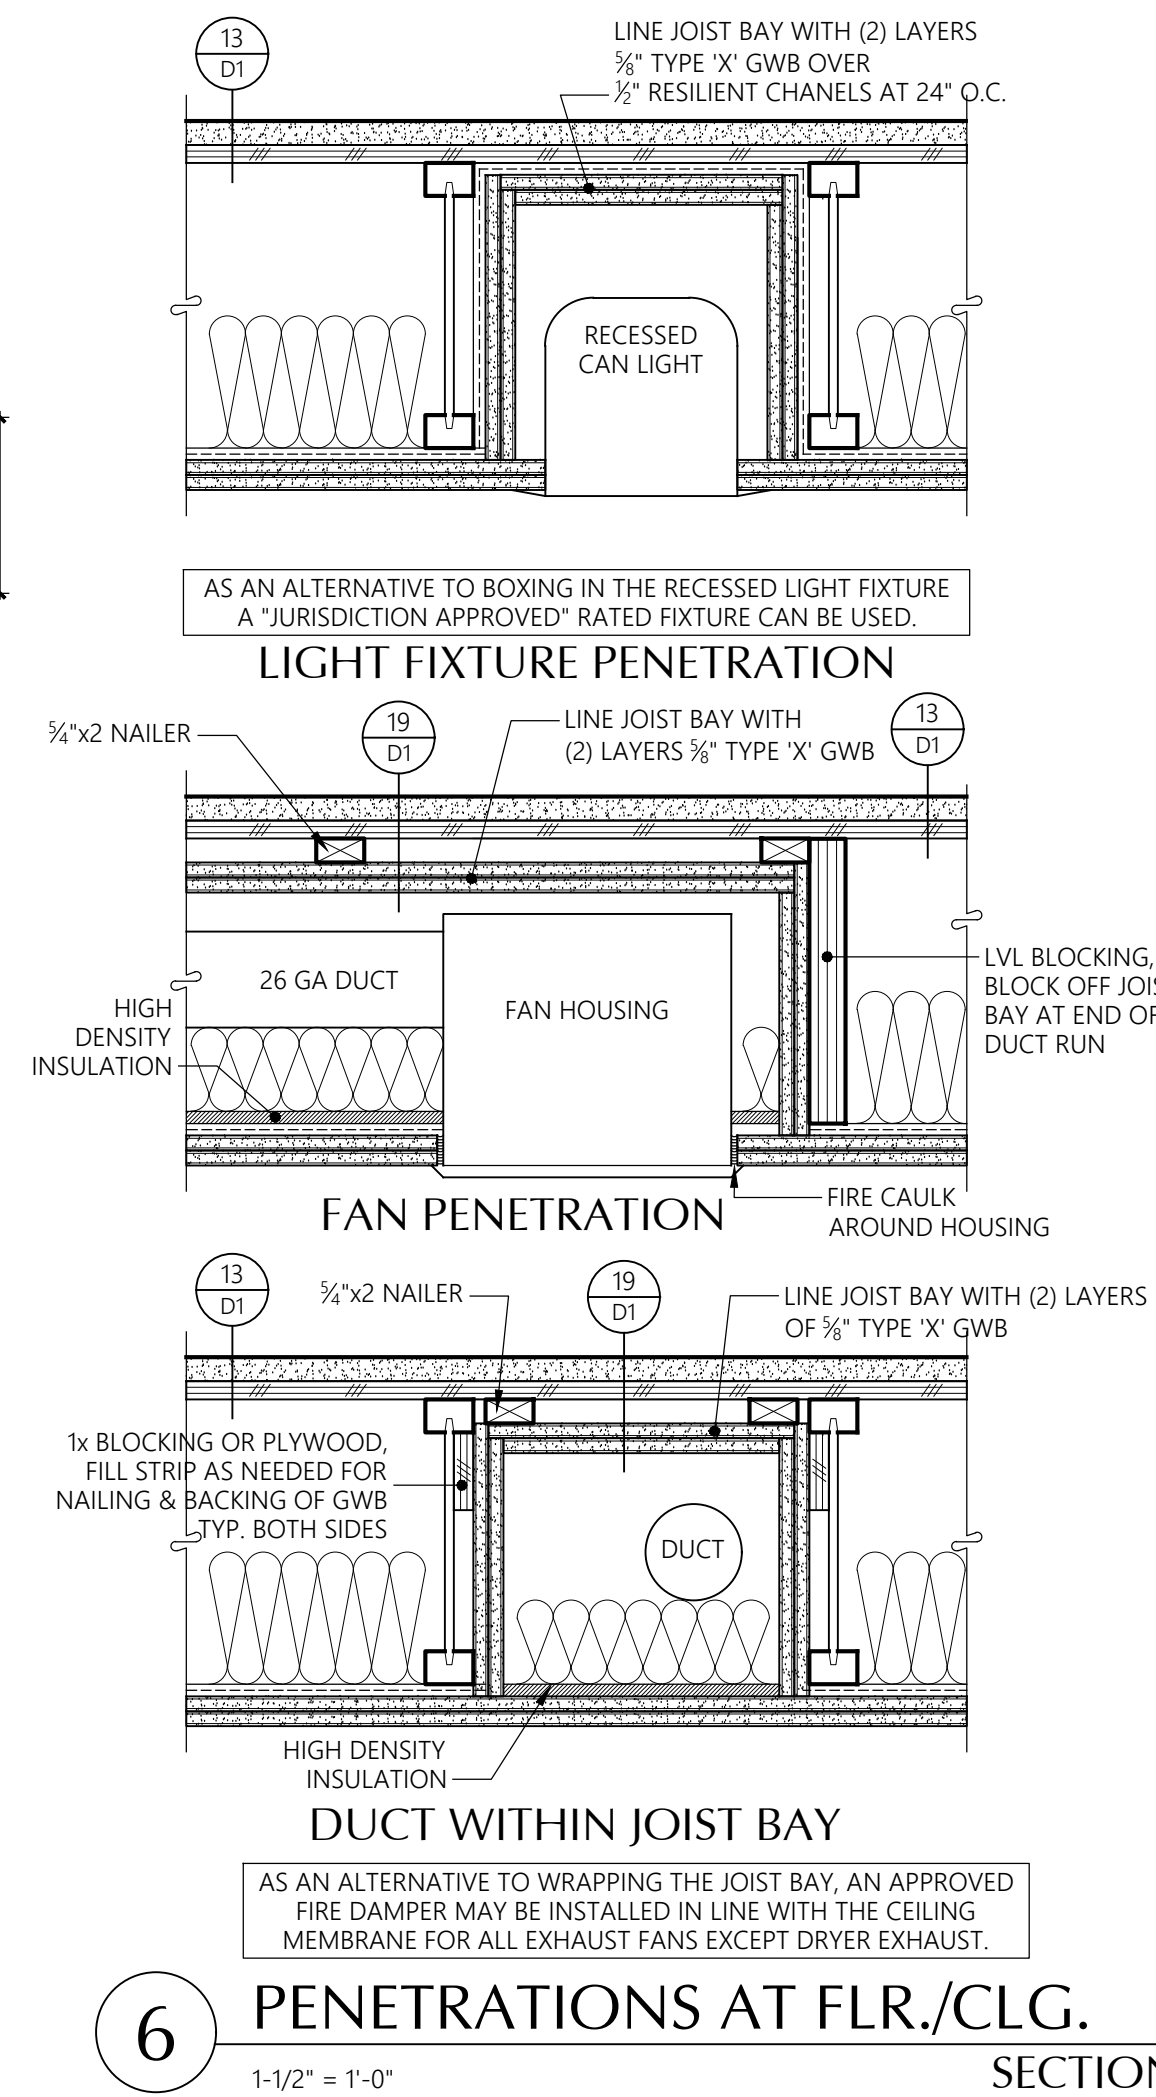

6 PENETRATIONS AT FLR./CLG. SECTION
1-1/2" = 1'-0"

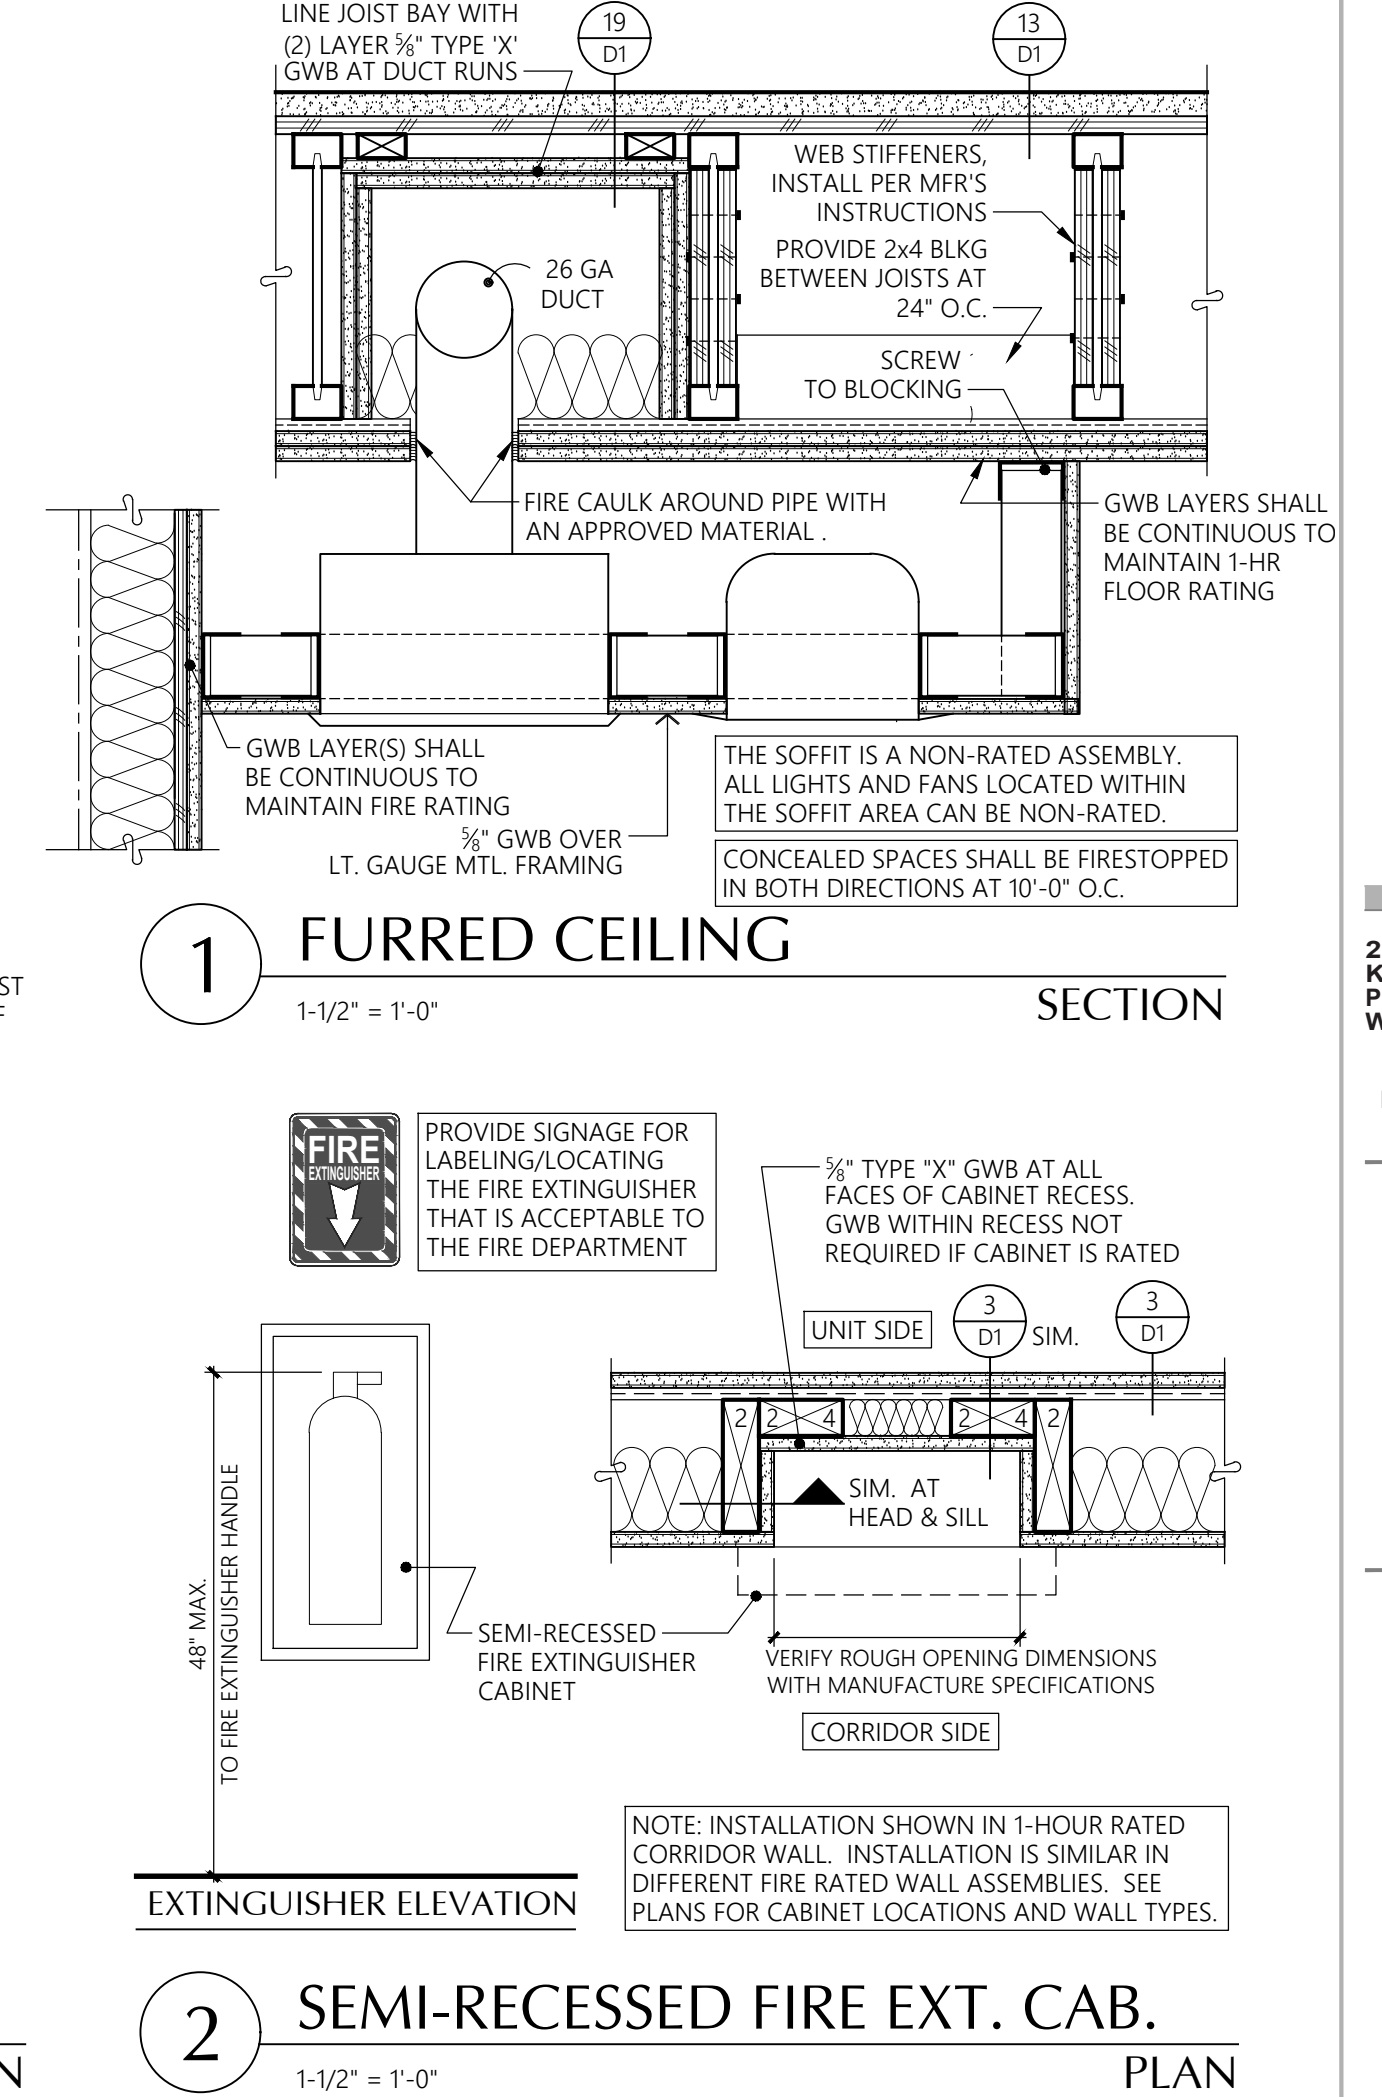

2 SEMI-RECESSED FIRE EXT. CAB. PLAN
1-1/2" = 1'-0"

INSULATION AND ENERGY NOTES

Insulation - General

All insulation materials shall be installed according to the manufacturer's instructions to achieve proper densities, and maintain uniform R-values. Substantial contact of the insulation with the surface being insulated is required.

Where required, insulation shall be installed with clearances according to manufacturer's specifications. Insulation shall be installed so that required ventilation is unobstructed. For blown or poured loose fill insulation clearances shall be maintained through installation of a permanent retainer.

Slab on Grade

R-10 slab on grade insulation shall be installed inside the foundation wall.

Insulated Floors

Floor insulation shall be installed in a permanent manner in substantial contact with the surface being insulated. Insulation supports shall be installed so spacing is no more than twenty-four inches on center.

Floors separating conditioned space from unconditioned space shall have a vapor barrier installed. Vapor barrier shall be installed on the warm side of the insulation. The vapor barrier shall have a one perm dry cup rating or less (i.e. four mil polyethylene or kraft faced material). The floor sheathing may be used as the vapor barrier if rated (and so stamped) at one perm (max). Otherwise place vapor barrier on top of joists before placing sheathing.

Exterior Walls

All wall insulation shall fill the entire cavity. Exterior wall cavities isolated during framing shall be fully insulated to the levels of the surrounding walls. All faced insulation shall be face stapled to avoid compression.

Walls separating conditioned space from unconditioned space shall have a vapor barrier installed. Faced batt insulation shall be face stapled. Vapor barrier shall be installed on the warm side of the insulation.

Air Leakage

These air leakage notes apply to those locations separating outdoor ambient conditions from interior spaces that are heated or mechanically cooled.

Exterior joints around windows and door frames, between wall cavities and window or door frames, openings between walls and foundation, between walls and roof and wall panels, openings of utility services through walls, floors and roof, and all other openings in the building envelope shall be sealed, caulked, gasketed, or weatherstripped to limit air leakage in a manner approved by the building official.

Doors

All exterior doors or doors serving as access to an enclosed unheated area shall be weatherstripped to limit leakage around their perimeter when in a closed position. The thermal transfer characteristics of insulated doors shall be determined per NFRC 100-91.

Windows:

Glazing U-values shall be determined in accordance with NFRC 100-91. Windows and SGD shall be double glazed vinyl type with the U-values indicated on the unit plans.

Windows shall be furnished with outdoor air inlets as indicated on the Unit Electrical plans. Inlets shall have a controllable and secure opening and be capable of a total opening area of not less than four (4) square inches and tested by a nationally recognized standard or approved agency and located to avoid drafts. Inlets shall be screened or otherwise protected from entry by insects, leaves, or other material.

Roof/Ceilings:

Roof/Ceiling insulation: Open-Blown or poured loose fill insulation may be used in attic spaces where the slope of the ceiling is more than 4 in 12 and there is at least 44 inches of clear distance from the top of the bottom chord of the truss or ceiling joist to the underside of the sheathing. When eave vents are installed, baffling of the vent openings shall be provided so as to deflect the incoming air above the surface of the insulation. Baffles shall be rigid material, resistant to wind driven moisture. When feasible, the baffles shall be installed from the top of the outside of the exterior wall, extending inward, to a point six inches vertically above the height of noncompressed insulation, and twelve inches vertically above loose fill insulation. Baffles shall be in place at the time of framing inspection.

Where the ventilation space above the insulation is less than an average of twelve inches roof ceiling assemblies shall be provided with a vapor barrier having a 0.5 perm cup rating or less. Faced batt insulation where used as a vapor barrier shall be face stapled.

Vapor barriers shall not be required in roof/ceiling assemblies where the ventilation space above the insulation averages twelve inches or greater.

Vapor barriers shall be installed on the warm side of the insulation.

GENERAL NOTES

GENERAL NOTES – MECHANICAL

- 1. REFERENCE TO RELATED WORK: "REF" INDICATIONS DENOTE WORK COVERED ELSEWHERE... 2. ELECTRICAL CHARACTERISTICS: REFER TO ELECTRICAL DRAWINGS... 3. CODES: COMPLETE INSTALLATION OF THE MECHANICAL SYSTEM...

PIPING NOTES

- 1. DISASSEMBLY PROVISIONS: PROVIDE UNIONS OR FLANGES AT PIPING CONNECTIONS... 2. REDUCERS: PROVIDE AS REQUIRED FROM LINE PIPE SIZE TO EQUIPMENT, TRAP, COIL, AND CONTROL VALVE CONNECTION SIZES.

INSULATION/LINING NOTES

- 1. ENERGY CODE: AS A MINIMUM, COMPLY WITH THICKNESSES AND TYPES LISTED IN ENERGY CODE ENFORCED BY AHJ. 2. EXTENT OF INTERNAL DUCT LINING: A. GRILLE AND DIFFUSER BOXES AND BOOTS. B. TRANSFER DUCTS. C. THE FIRST 10 FEET OF SUPPLY AND RETURN DUCTWORK FROM THE AIR HANDLER.

PLAN NOTES

- 1. DUCTWORK SHALL BE METALLIC DUCTWORK 2. TEST AND BALANCE WORK SHALL BE PERFORMED BY AN INDEPENDENT TEST AND BALANCE AGENCY... 3. COORDINATE DUCTWORK WITH MISCELLANEOUS OBSTRUCTIONS IN CEILING SPACE.

SHEET METAL NOTES

- 1. REFERENCE: SMACNA HVAC DUCT CONSTRUCTION STANDARDS, METAL AND FLEXIBLE, CURRENT EDITION. 2. CLEARANCE: COORDINATE DUCTWORK WITH MISCELLANEOUS OBSTRUCTIONS IN CEILING SPACE. 3. ROUND ELBOWS AND OFFSETS: FULL RADIUS (R/D = 1.5), 5-PIECE SEGMENTED OR STAMPED. REFER TO SMACNA HVAC FIG 2-7, 3-3.

COORDINATION REQUIREMENTS

- 1. PIPING: COORDINATE WITH STRUCTURAL FOR EXACT LOCATION OF ALL STRUCTURAL FRAMING AND FOOTINGS AND FINALIZE THE EXACT ROUTING OF ALL PIPES WITH STRUCTURAL AND AT THE SITE PRIOR AND DURING THE CONSTRUCTION. 2. DUCTWORK: LOCATE AND COORDINATE THE EXACT LOCATION OF DUCTWORK WITH STRUCTURAL PLANS AND WITH THE GENERAL CONTRACTOR PRIOR TO INSTALLATION...

HVAC NOTES

- 1. ATTACHMENTS: AIR DISTRIBUTION OUTLETS AND LOUVERS

- SHALL HAVE ALL REQUIRED ACCESSORIES AND ATTACHMENTS FOR A COMPLETE CONNECTION TO THE SPECIFIC TYPE OF STRUCTURE THAT THEY ARE BEING ATTACHED TO... 2. DUCTWORK: DUCTWORK SHALL BE SMOOTH SHEET METAL (CLASS-1). DUCTWORK THROUGH FIRE RATED STRUCTURE AND FLOOR SHALL BE MIN. 26 GA. STEEL... 3. SEISMIC: PROVIDE SEISMIC RESTRAINTS FOR MECHANICAL EQUIPMENT, PIPING, AND DUCTWORK PER SMACNA AND LOCAL REGULATIONS.

APPLICABLE CODE

BUILDING CODE:

- 2018 WASHINGTON STATE ENERGY CODE—RESIDENTIAL BY WASHINGTON ADMINISTRATIVE CODE CHAP 51-50 (WSEC) 2018 INTERNATIONAL RESIDENTIAL CODE WITH ADMINISTRATIVE CODE CHAP 51-51 (WSRC) 2018 INTERNATIONAL MECHANICAL CODE WITH ADMINISTRATIVE CODE CHAP 51-52 (WSMC)

DRAWINGS ARE DIAGRAMMATIC, SHOWING THE GENERAL LOCATION, TYPE, LAYOUT, AND EQUIPMENT REQUIRED. THE DRAWINGS SHALL NOT BE SCALED FOR EXACT MEASUREMENT. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS. REFER TO MANUFACTURER'S STANDARD INSTALLATION DRAWINGS FOR EQUIPMENT CONNECTIONS AND INSTALLATION REQUIREMENTS. PROVIDE DUCTWORK, CONNECTIONS, ACCESSORIES, OFFSETS, AND MATERIALS NECESSARY FOR A COMPLETE SYSTEM.

PRE-CON MEETING NOTES

CONTRACTORS SHALL ATTEND A PRE-CONSTRUCTION MEETING WITH THE ENGINEER FOR THE PURPOSE OF REVIEWING THE WORK PRIOR TO ORDERING ANY EQUIPMENT OR PERFORMING ANY WORK. THE MEETING SHALL BE LOCATED AT THE PROJECT SITE ON A DATE AND TIME TO BE MUTUALLY AGREED. THE MEETING WILL BE A WORKING SESSION. THE MEETING WILL BE FACILITATED BY THE ENGINEER AND THE AGENDA WILL INCLUDE A DETAILED REVIEW OF THE PLANS AND SPECIFICATIONS, CROSS CHECK WITH OTHER TRADES FOR COORDINATION ISSUES, REVIEW OF PROPOSED PRODUCTS, REVIEW OF PLANNED MEANS AND METHODS, AND ON-SITE INVESTIGATION OF FIELD CONDITIONS RELATIVE TO EXISTING CONDITIONS THAT COULD AFFECT THE WORK.

THE FOLLOWING TRADES SHALL BE REPRESENTED FOR THE MINIMUM TIME INDICATED:

Table with 2 columns: Trade Name, Time/Session. Includes MECHANICAL SHEET METAL (4 HOURS), PLUMBING/PIPING (4 HOURS), ELECTRICAL (4 HOURS), SPRINKLER (2 HOURS), GENERAL CONTRACTOR (ALL SESSIONS).

ANNOTATIONS

- ACU AIR CONDITIONING UNIT ABOVE FINISHED FLOOR AUTHORITY HAVING JURISDICTION AIR HANDLING UNIT BACKDRAFT DAMPER BRAKE HORSEPOWER BRITISH THERMAL UNIT PER HOUR COMMON CAPACITY COOLING COIL CEILING DIFFUSER CUBIC FEET PER MINUTE CEILING, COOLING CLEANOUT COMBUSTION CONTINUE, CONTROL CONTRACTOR COEFFICIENT OF PERFORMANCE CHILLED WATER SUPPLY CHILLED WATER RETURN DIAMETER DRY BULB, DECIBEL DEGREE DIMENSION DISCHARGE DOWN EXHAUST AIR ENTERING AIR TEMPERATURE ENERGY EFFICIENCY RATIO EXHAUST FAN EFFICIENCY EXHAUST GRILLE, ENGINE GENERATOR ELECTRIC EQUIVALENT EXTERNAL STATIC PRESSURE EXHAUST EXTERIOR, EXTERNAL FAHRENHEIT FAN DAMPER FAN COIL UNIT FLOOR FEET PER MINUTE FEET PER SECOND FIRE/SMOKE DAMPER GAS GRILLES, REGISTERS, AND DIFFUSERS GYPSUM WALLBOARD HORIZONTAL HORSEPOWER, HEAT PUMP HP HEAT RECOVERY UNIT HEATING, VENTILATING, AND AIR CONDITIONING HEATING AND VENTILATION UNIT HIGH WALL RETURN, HOT WATER RETURN HIGH WALL SUPPLY, HOT WATER SUPPLY HEAT EXCHANGER INDIRECT DRAIN, INSIDE DIAMETER INCH KILOWATT LONG, LENGTH POUND LOW WALL RETURN LOW WALL SUPPLY THOUSAND BTU PER HOUR MECHANICAL MINIMUM CIRCUIT AMPACITY MAXIMUM OVER CURRENT PROTECTION MOUNTED MOUNTED OUTDOOR AIR OPPOSED BLADE DAMPER OUTSIDE DIMENSION OR DIAMETER OPENING PUMP PRESSURE DROP POINT OF CONNECTION PRESSURE REDUCING VALVE POUNDS PER SQUARE INCH GAUGE RETURN AIR REFERENCE RELIEF FAN RETURN GRILLE REVOLUTIONS PER MINUTE SUPPLY AIR SCHEDULE SUPPLY FAN, SQUARE FOOT SENSIBLE SUPPLY GRILLE SHEET METAL AND AIR CONDITIONING CONTRACTORS NATIONAL ASSOCIATION SCREENED OPENING STATIC PRESSURE STAINLESS STEEL, SANITARY SEWER SQUARE TRANSFER GRILLE TYPICAL UNIT HEATER UNLESS OTHERWISE NOTED VENT VENTILATION, VENTILATOR VENT THRU ROOF WASTE, WATT, WIDE WET BULB (TEMPERATURE)

SYMBOLS

DUCTWORK: 18x12, 18x12, etc. EQUIPMENT: DUCT SMOKE DETECTOR, ROOM THERMOSTAT OR TEMPERATURE TRANSMITTER, ROOM HUMIDISTAT OR HUMIDITY TRANSMITTER, CARBON MONOXIDE SENSOR SMOKE DETECTOR, TERMINALS, DIFFUSER/GRILLE TYPE, AND NUMBER OR SIZE, DESIGN CFM (WHERE APPLICABLE) CEILING DIFFUSER (FLOW ARROWS SHOWN FOR NON SYMMETRICAL AIRFLOW), CEILING RETURN/EXHAUST GRILLE, LINEAR DIFFUSER, CEILING OR WALL MOUNTED (FLOW ARROWS SHOWN FOR NON SYMMETRICAL AIRFLOW), WALL SUPPLY GRILLE (SG), WALL RETURN/EXHAUST GRILLE (RG, EG), TRANSFER GRILLE (TG), DUCT CONNECTED, WALL MOUNTED W/ OPTIONAL CFM SHOWN TRANSFER GRILLE, CEILING MOUNTED WITH FULL-SIZED LINED DUCT CONNECTION.

DRAWING INDEX

Table with 4 columns: DWG, DESCRIPTION, PERMIT SET, DATE. Rows include M0.0 (LEGEND, GENERAL NOTES, & DRAWING INDEX), M0.1 (PROJECT NOTES), M0.2 (TABLES & CALCULATIONS), M0.3 (MECHANICAL SCHEDULES & WSEC FORMS), M2.0 (HVAC PLAN - BASEMENT & 1ST LEVEL), M2.1 (HVAC PLAN - 2ND & 3RD LEVEL), M3.0 (HVAC ENLARGED PLANS), M3.1 (HVAC ENLARGED PLANS).

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A 202 27TH AVE SE PUYALLUP, WA 98374


19401 40TH AVE W, SUITE 302 LYNNWOOD, WA 98036 PHONE: (206)364-3343

DATE: 02/15/2024

SHEET TITLE: LEGEND, GENERAL NOTES, & DRAWING INDEX

SHEET NO. M0.0

Table with columns: NO., DATE, DESCRIPTION, REVISIONS.

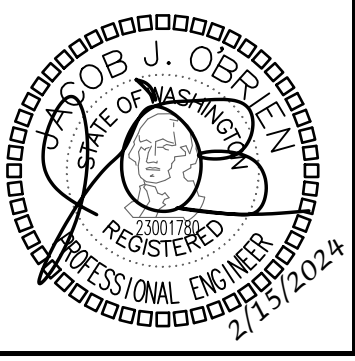

ROBISON ENGINEERING, INC. 19401 40TH AVE W, SUITE 302 LYNNWOOD, WA 98036 PHONE: (206)364-3343 PROJECT NO. 271006 CONTACT: AME@REIWA.COM

Table with columns: DRAWN, OP, DESIGNED, ABE, CHECKED, ABE, APPROVED, JOB.

WHOLE HOUSE VENTILATION NOTES

EACH DWELLING UNIT OR SLEEPING UNIT SHALL BE EQUIPPED WITH A WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM THAT COMPLIES WITH SECTIONS 403.4.1 THROUGH 403.4.6. EACH DWELLING UNIT OR SLEEPING UNIT SHALL BE EQUIPPED WITH LOCAL EXHAUST COMPLYING WITH SECTION 403.4.7. ALL OCCUPIED SPACES, INCLUDING PUBLIC CORRIDORS, OTHER THAN GROUP R DWELLING UNITS AND/OR SLEEPING UNITS, THAT SUPPORT THESE GROUP R OCCUPANCIES, SHALL MEET THE VENTILATION REQUIREMENTS OF SECTION 402 OR THE MECHANICAL VENTILATION REQUIREMENTS OF SECTIONS 403.1 THROUGH 403.3.

THE WHOLE HOUSE VENTILATION SYSTEM SHALL CONSIST OF ONE OR MORE SUPPLY FANS, ONE OR MORE EXHAUST FANS, OR AN ERV/HRV WITH INTEGRAL FANS; AND THE ASSOCIATED DUCTS AND CONTROLS. LOCAL EXHAUST FANS SHALL BE PERMITTED TO SERVE AS PART OF THE WHOLE-HOUSE VENTILATION SYSTEM WHEN PROVIDED WITH THE PROPER CONTROLS IN ACCORDANCE WITH SECTION 403.4.5. THE SYSTEMS SHALL BE DESIGNED AND INSTALLED TO SUPPLY AND EXHAUST THE MINIMUM OUTDOOR AIRFLOW RATES PER SECTION 403.4.2 AS CORRECTED BY THE BALANCED AND/OR DISTRIBUTED WHOLE-HOUSE VENTILATION SYSTEM COEFFICIENTS IN ACCORDANCE WITH SECTION 403.4.3 WHERE APPLICABLE.

THE DWELLING UNIT WHOLE-HOUSE MECHANICAL VENTILATION MINIMUM OUTDOOR AIRFLOW RATE SHALL BE DETERMINED IN ACCORDANCE WITH EQUATION 4-10 OR TABLE 403.4.2.

RESIDENTIAL DWELLING AND SLEEPING UNITS IN GROUP R-2 OCCUPANCIES SYSTEM SHALL INCLUDE SUPPLY AND EXHAUST FANS AND BE A BALANCED WHOLE-HOUSE VENTILATION SYSTEM IN ACCORDANCE WITH SECTION 403.4.6.3. THE SYSTEM SHALL INCLUDE A HEAT OR ENERGY RECOVERY VENTILATOR WITH A SENSIBLE HEAT RECOVERY EFFECTIVENESS AS PRESCRIBED IN SECTION C403.3.6 OF THE WASHINGTON STATE ENERGY CODE. THE WHOLE-HOUSE VENTILATION SYSTEM SHALL OPERATE CONTINUOUSLY AT THE MINIMUM VENTILATION RATE DETERMINED IN ACCORDANCE WITH SECTION 403.4. THE WHOLE-HOUSE SUPPLY FAN SHALL PROVIDE DUCTED OUTDOOR VENTILATION AIR TO EACH HABITABLE SPACE WITHIN THE RESIDENTIAL UNIT.

CONTROLS FOR THE WHOLE-HOUSE VENTILATION SYSTEM SHALL COMPLY WITH THE FOLLOWING:

1. THE WHOLE-HOUSE VENTILATION SYSTEM SHALL BE CONTROLLED WITH MANUAL SWITCHES, TIMERS OR OTHER MEANS THAT PROVIDE FOR AUTOMATIC OPERATION OF THE VENTILATION SYSTEM THAT HAVE READY ACCESS FOR THE OCCUPANT.
2. THE WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM SHALL BE PROVIDED WITH CONTROLS THAT ENABLE MANUAL OVERRIDE OFF OF THE SYSTEM BY THE OCCUPANT DURING PERIODS OF POOR OUTDOOR AIR QUALITY. CONTROLS SHALL INCLUDE PERMANENT TEXT OR A SYMBOL INDICATING THEIR FUNCTION. RECOMMENDED CONTROL PERMANENT LABELING TO INCLUDE TEXT SIMILAR TO THE FOLLOWING; "LEAVE ON UNLESS OUTDOOR AIR QUALITY IS VERY POOR."
3. WHOLE-HOUSE VENTILATION SYSTEMS SHALL BE CONFIGURED TO OPERATE CONTINUOUSLY EXCEPT WHERE INTERMITTENT OFF CONTROLS ARE PROVIDED IN ACCORDANCE WITH SECTION 403.4.6.5 AND ALLOWED BY SECTION 403.4.4.2.

WHOLE HOUSE VENTILATION SUPPLY AND EXHAUST FANS SPECIFIED IN THIS SECTION SHALL HAVE A MINIMUM EFFICACY AS PRESCRIBED IN THE WASHINGTON STATE ENERGY CODE. THE FANS SHALL BE RATED FOR SOUND AT A MAXIMUM OF 1.0 SONE AT DESIGN AIRFLOW AND STATIC PRESSURE CONDITIONS. DESIGN AND INSTALLATION OF THE SYSTEM OR EQUIPMENT SHALL BE CARRIED OUT IN ACCORDANCE WITH MANUFACTURERS' INSTALLATION INSTRUCTIONS

A BALANCED WHOLE HOUSE VENTILATION SYSTEM SHALL INCLUDE BOTH SUPPLY AND EXHAUST FANS. THE SUPPLY AND EXHAUST FANS SHALL HAVE AIRFLOW THAT IS WITHIN 10 PERCENT OF EACH OTHER. THE TESTED AND BALANCED TOTAL MECHANICAL EXHAUST AIRFLOW RATE IS WITHIN 10 PERCENT OR 5 CFM, WHICHEVER IS GREATER, OF THE TOTAL MECHANICAL SUPPLY AIRFLOW RATE. THE FLOW RATE TEST RESULTS SHALL BE SUBMITTED AND POSTED IN ACCORDANCE WITH SECTION 403.4.6.6. THE EXHAUST FAN SHALL MEET THE REQUIREMENTS OF SECTION 403.4.6.2. THE SUPPLY FAN SHALL MEET THE REQUIREMENTS OF SECTION 403.4.6.3. FOR R-2 DWELLING AND SLEEPING UNITS, THE SYSTEM IS REQUIRED TO HAVE BALANCED WHOLE-HOUSE VENTILATION BUT IS NOT REQUIRED TO HAVE DISTRIBUTED WHOLE-HOUSE VENTILATION WHERE THE NOT DISTRIBUTED SYSTEM COEFFICIENT FROM TABLE 403.4.3 IS UTILIZED TO CORRECT THE WHOLE-HOUSE MECHANICAL VENTILATION RATE. THE SYSTEM SHALL BE DESIGNED AND BALANCED TO MEET THE PRESSURE EQUALIZATION REQUIREMENTS OF SECTION 501.4. INTERMITTENT DRYER EXHAUST, INTERMITTENT RANGE HOOD EXHAUST, AND INTERMITTENT TOILET ROOM EXHAUST AIRFLOW RATES ABOVE THE RESIDENTIAL DWELLING OR SLEEPING UNIT MINIMUM VENTILATION RATE ARE EXEMPT FROM THE BALANCED AIRFLOW CALCULATION.

FACTORY-BUILT INTAKE/EXHAUST COMBINATION TERMINATIONS

PER 2018 IMC 401.4.3, ITEM 3, EXCEPTION, SEPARATION IS NOT REQUIRED BETWEEN INTAKE AIR OPENINGS AND LIVING SPACE RELIEF AIR EXHAUST AIR OPENINGS OF AN INDIVIDUAL DWELLING UNIT OR SLEEPING UNIT, NOT TO INCLUDE COMMON AREAS OUTSIDE OF THE DWELLING OR SLEEPING UNIT, WHERE A FACTORY-BUILT INTAKE/EXHAUST COMBINATION TERMINATION FITTING, LISTED AND INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS, IS USED TO SEPARATE THE AIR STREAMS. A MINIMUM OF 5 FEET HORIZONTAL SEPARATION BETWEEN OTHER ENVIRONMENTAL AIR EXHAUST OUTLETS AND OTHER DWELLING OR SLEEPING UNIT FACTORY-BUILT INTAKE/EXHAUST COMBINATION TERMINATION FITTINGS SHALL BE MAINTAINED.


CALCULATIONS

RESIDENTIAL VENTILATION CALCULATIONS

UNIT TYPE	UNIT SQUARE FOOTAGE	NUMBER OF BEDROOMS	2018 IMC CRITERIA (1)			VENTILATION QUALITY ADJUSTMENT COEFFICIENT (3)	MINIMUM WHOLE HOUSE VENTILATION RATE, CFM	TOTAL CFM PROVIDED BY WHOLE HOUSE FAN SYSTEM
			FLOOR AREA, SQFT	NUMBER OF BEDROOMS	REQUIRED CFM (2)			
1 BEDROOM	660	1	500 - 1,000	1	30	1.5	45	55
2 BEDROOM	1000	2	500 - 1,000	2	35	1.5	53	55

- NOTE:
- (1) VENTILATION CRITERIA IS PER THE 2018 WA RESIDENTIAL CODE SECTION M1505.4.3
 - (2) MINIMUM OSA FOR CONTINUOUSLY OPERATING FAN(S).
 - (3) ADJUSTMENT COEFFICIENT IS PER 2018 WRC, TABLE M1505.4.3(2) FOR A NOT BALANCED, AND NOT DISTRIBUTED WHOLE HOUSE VENTILATION SYSTEM.

NO.	DATE	DESCRIPTION

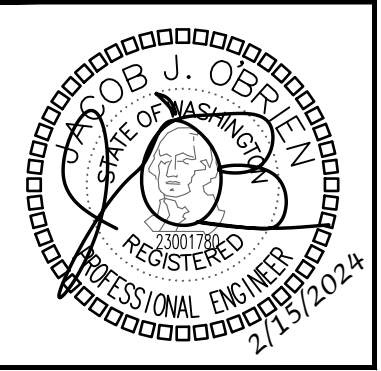

DRAWN: OP	DESIGNED: ABE	CHECKED: ABE	APPROVED: JOB
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A
 202 27TH AVE SE
 PUYALLUP, WA 98374
 19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343
ROBISON ENGINEERING, INC.

DATE: 02/15/2024

SHEET TITLE:
TABLES & CALCULATIONS

SHEET NO.
M0.2

WSEC FORMS

6/16/23, 10:22 AM waenergycodes.com/print_project_summary_form.php?k=aWQ9MTkxMjE3MmN0aT00Ng==&print=1

MECHANICAL COMPLIANCE SUMMARY

2018 WSEC Compliance Forms for Commercial Buildings including Group R2, R3 & R4 over 3 stories and all R1 Administered by: ©2023 NEEA, All rights reserved

Project Title: Bradley Heights Apartments Building A - 2018 WSEC For Building Department Use: **Date: Jun 16, 2023**

Project Address: 202 27th Ave SE Puyallup, WA 98374

Applicant Name: Ark Espineli

Applicant Phone: 206-364-3343

Applicant Email: aespinel@robisonengineering.com

For questions about this report, contact WSEC Commercial Technical Support at 360-539-5300 or via email at com.technicalsupport@waenergycodes.com

General Occupancy: All Group R - R2, R3 & R4 over 3 stories and all R1 General Building Use Type: Multifamily/Residential Building Cond. Floor Area: 22,788

General Project Types: New Building New Building or Addition Mechanical Scope: Single Zone Systems & Equipment Alteration Mechanical Scope: Project Cond. Floor Area: 22,788 Floors Above Grade: 3 Compliance Method: 1 - General

Mechanical Project Description: Full mechanical design for new 3 story residential building with basement.

Mechanical Compliance Scope and Method	Project Type	Mechanical Scope	Economizer Exception(s) Applied?	DOAS Ventilation Provided?	Higher Equipment Efficiency Option Applied?	Equipment Efficiency Compliance Verification
	New Building	Single Zone Systems & Equipment	No	Yes	NA	COMPLIES

Additional Efficiency Credits Included (AEC):

Does building include occupancy classifications requiring DOAS? No Does project include DOAS equipment? Yes

Based on project scope do TSPR requirements apply? No Do all systems comply with Appendix D standard reference design or qualify for an exception to TSPR? No

Scope & Space Conditioning: **NEW BUILDING - SINGLE ZONE SYSTEMS & EQUIPMENT** Compliance Verification: **COMPLIES**

Single Zone Air Systems Category - Unit heaters & duct heaters

System/Equip ID	Quantity of Items	Ventilation Standard	Ventilation CFM (Total if Multiple Items)	Ventilation Air Source	Paired with DOAS
EW1-1	48	IMC Ventilation		Other System	
EW1-2	7	IMC Ventilation		Other System	

System/Equip ID	Heating System/Equip Type	Specific Type	Heating Capacity	HC Units	Proposed Heating Efficiency	HE Units	Efficiency Compliance Verification
EW1-1	Unit heater	Electric resistance	1	Btu/h			COMPLIES
EW1-2	Unit heater	Electric resistance	2	Btu/h			COMPLIES

System/Equip ID	Area(s) Served	Location In Project Documents - Plan/Detail #
EW1-1	APARTMENT UNITS	M0.3
EW1-2	APARTMENT UNITS	M0.3

System/Equip ID for a single or multiple items? Multiple items w/ identical heating & cooling capacity

System/Equip ID for a single or multiple items? Multiple items w/ identical heating & cooling capacity

https://waenergycodes.com/print_project_summary_form.php?k=aWQ9MTkxMjE3MmN0aT00Ng==&print=1 1/1

MECHANICAL SCHEDULES


ELECTRIC HEATERS					
EQUIP NO.	SERVICE	MOUNTING/ DISCHARGE	HEATING	ELECTRICAL	BASIS OF DESIGN (3)
			KW	VOLTAGE	
EW1-1	APARTMENT UNIT	WALL	1.0	208V/1P	(1)(2)
EW1-2	APARTMENT UNIT	WALL	1.5	208V/1P	(1)(2)

- NOTES: (1) BROAN, KING, CADET OR EQUIVALENT.
 (2) PROVIDE REMOTE THERMOSTAT. COORDINATE FINAL LOCATION WITH ELECTRICAL DRAWINGS.
 (3) ALL ELECTRIC HEATERS TO BE FURNISHED AND INSTALLED BY ELECTRICAL CONTRACTOR.

FAN SCHEDULE									
EQUIP NO.	SERVICE	TYPE	AIRFLOW, CFM	ESP. IN WG	ELECTRICAL		OPERATION	WEIGHT, LBS	BASIS OF DESIGN (1)(2)(3)
					VOLTAGE	HP			
BEF-1	RESTROOM	CEILING MOUNTED	55/80	0.5	115V/1P	FHP	CONTINUOUS	10	GREENHECK SP-AP0511W (4)
BEF-2	RESTROOM	CEILING MOUNTED	50	0.5	115V/1P	FHP	(2)	10	GREENHECK SP-AP0511W

- NOTES: (1) PROVIDE BACKDRAFT DAMPERS ON EXHAUST FANS.
 (2) 1.0 SONES MAXIMUM.
 (3) VIBRATION ISOLATION: FANS < 125 LBS RUBBER ISOLATORS, FANS > 125 LBS SPRING ISOLATORS
 (4) FAN SHALL BE 2-SPEED: 35 CFM CONTINUOUS LOW SETTING AND 80 CFM HIGH SPEED ACTIVATED BY INTEGRAL OCCUPANCY SENSOR ON GRILLE.

NO.	DATE	DESCRIPTION	REVISIONS

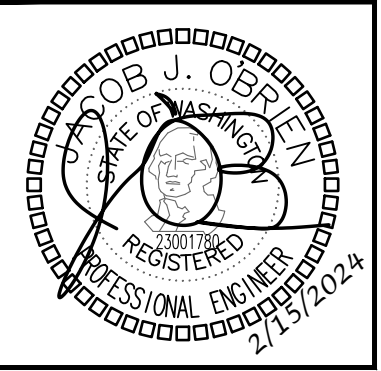

DRAWN: OP	DESIGNED: ABE	CHECKED: ABE	APPROVED: JOB
-----------	---------------	--------------	---------------

PROJECT: **BRADLEY HEIGHT APARTMENTS - BUILDING A**
 202 27TH AVE SE
 PUYALLUP, WA 98374


19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 206-364-3343
 PHONE: (206) 364-3343

ROBISON ENGINEERING, INC.

DATE: 02/15/2024


SHEET TITLE: **MECHANICAL SCHEDULES & WSEC FORMS**

SHEET NO. **M0.3**

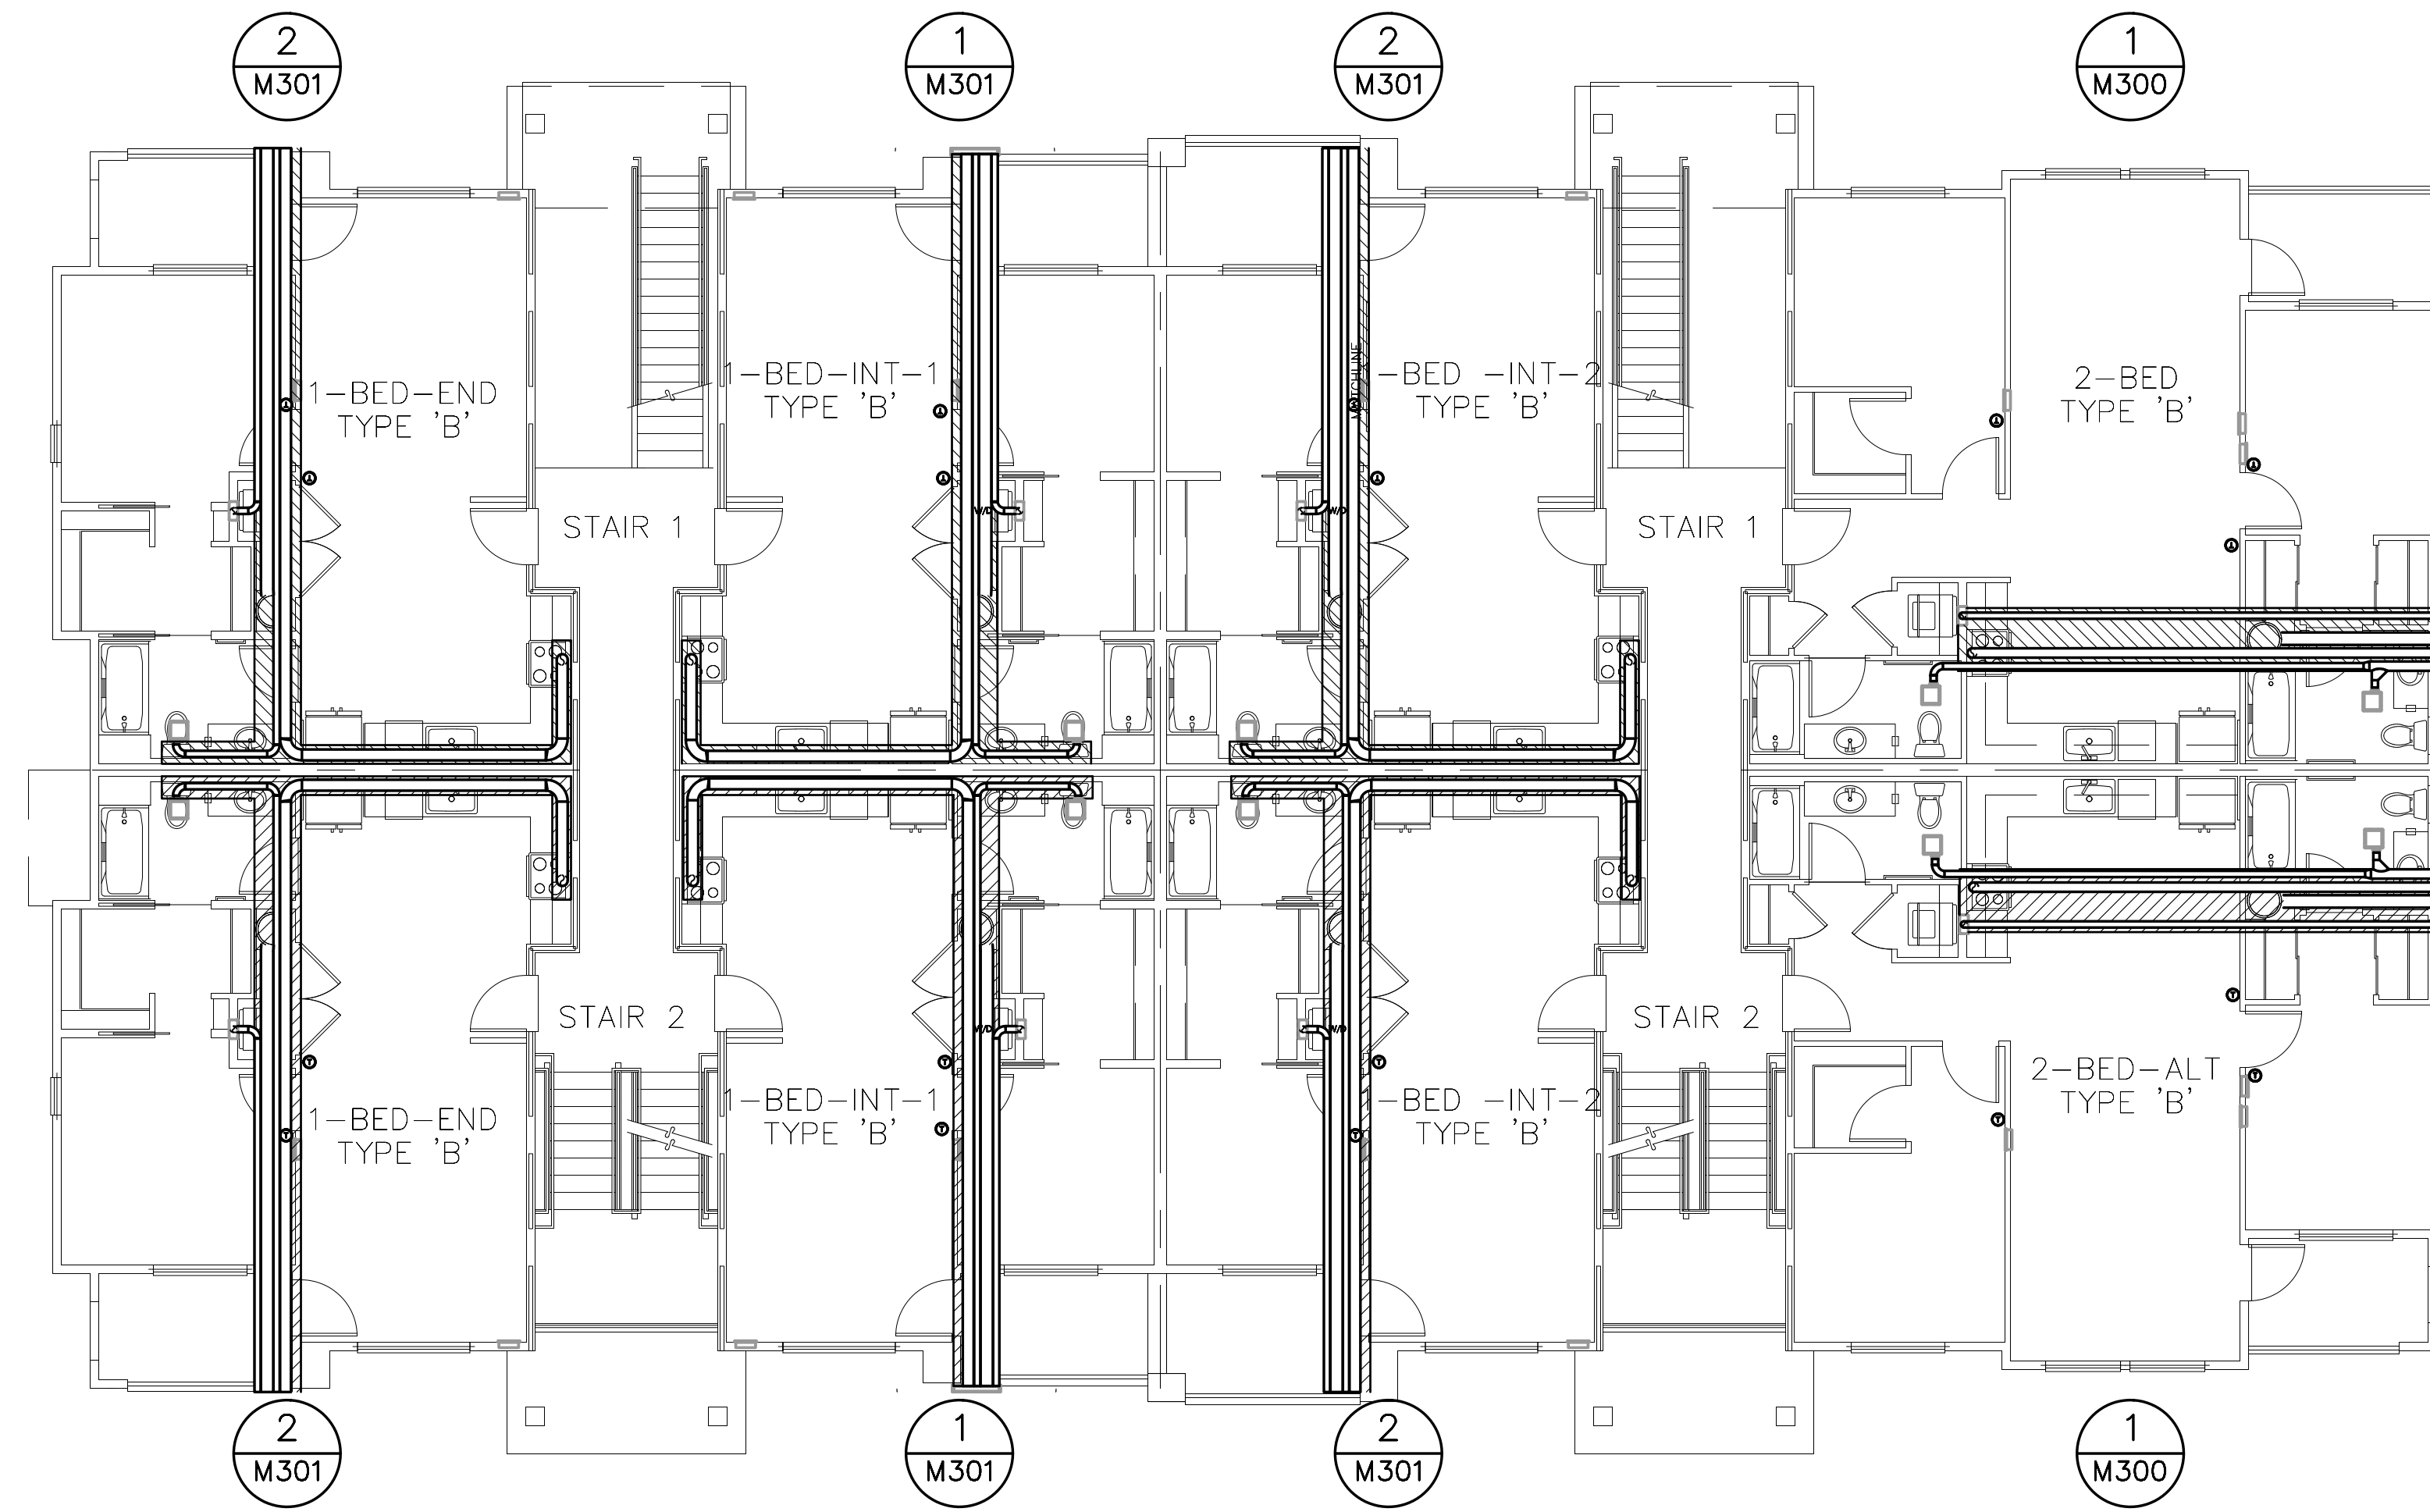

BUILDING A 1st LEVEL PLAN
1/8" = 1'-0" 3/4 SPLIT LEVEL, 28-UNIT BUILDING

Provide lengths to all duct work for all floors to identify maximum duct length for all areas.
Page M3.0


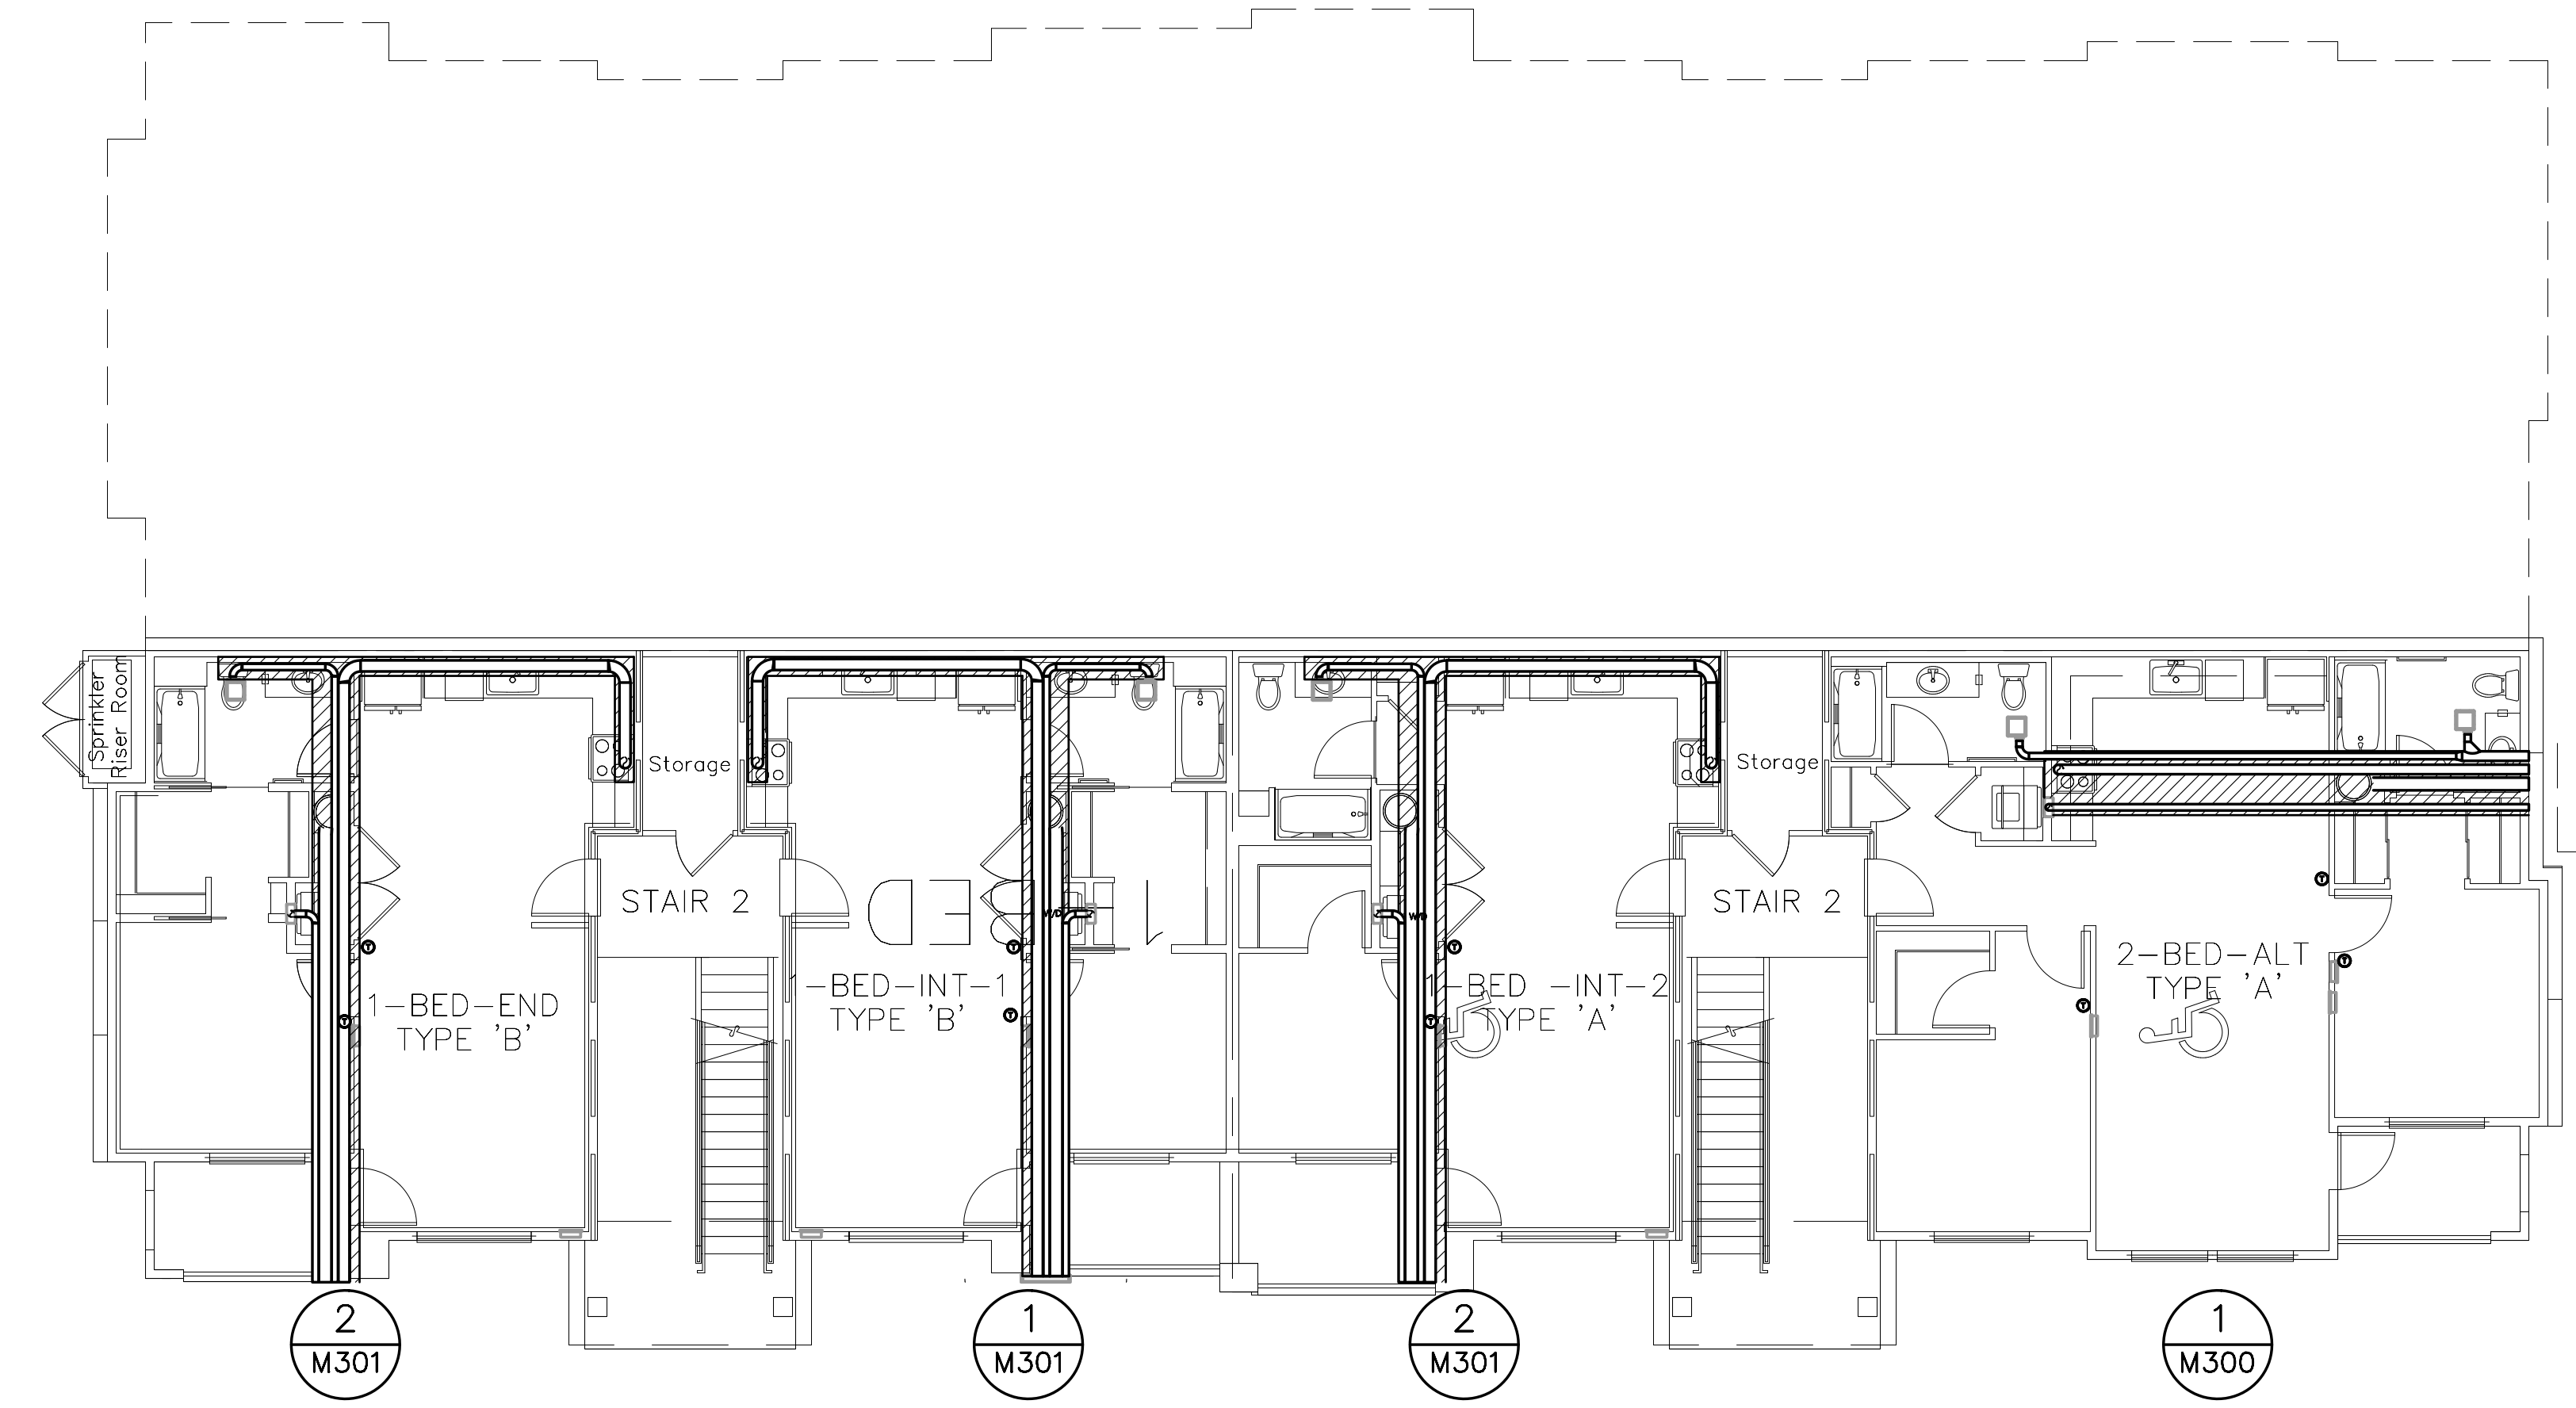


BUILDING A BASEMENT LEVEL PLAN
1/8" = 1'-0" 3/4 SPLIT LEVEL, 28-UNIT BUILDING

Did not locate sheets M300-M303 duct sizes and length.
Page M2.0

RESIDENTIAL UNIT NOTES:
 =REFER TO DWG M300, DETAIL 1.
 FOR DUCT SIZES WITHIN THE RESIDENTIAL UNITS, REFER TO THE ENLARGED UNIT PLANS ON DWGS M300-M303.

NO.	DATE	DESCRIPTION	REVISIONS

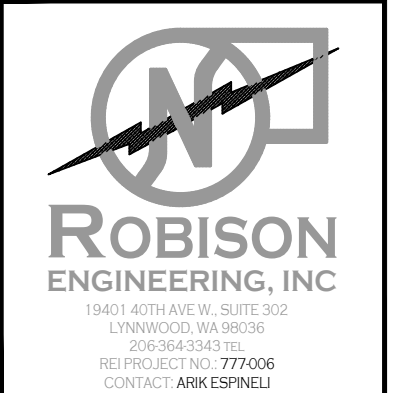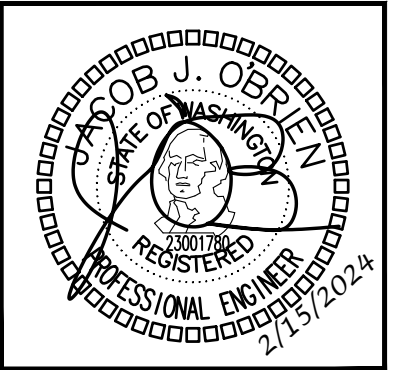


DRAWN: OP	DESIGNED: ABE	CHECKED: ABE	APPROVED: JOB
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A
202 27TH AVE SE
PUYALLUP, WA 98374
19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 864-3343
ROBISON ENGINEERING, INC.


DATE: 02/15/2024

SHEET TITLE:
HVAC PLAN
- BASEMENT
& 1ST LEVEL

SHEET NO.
M2.0

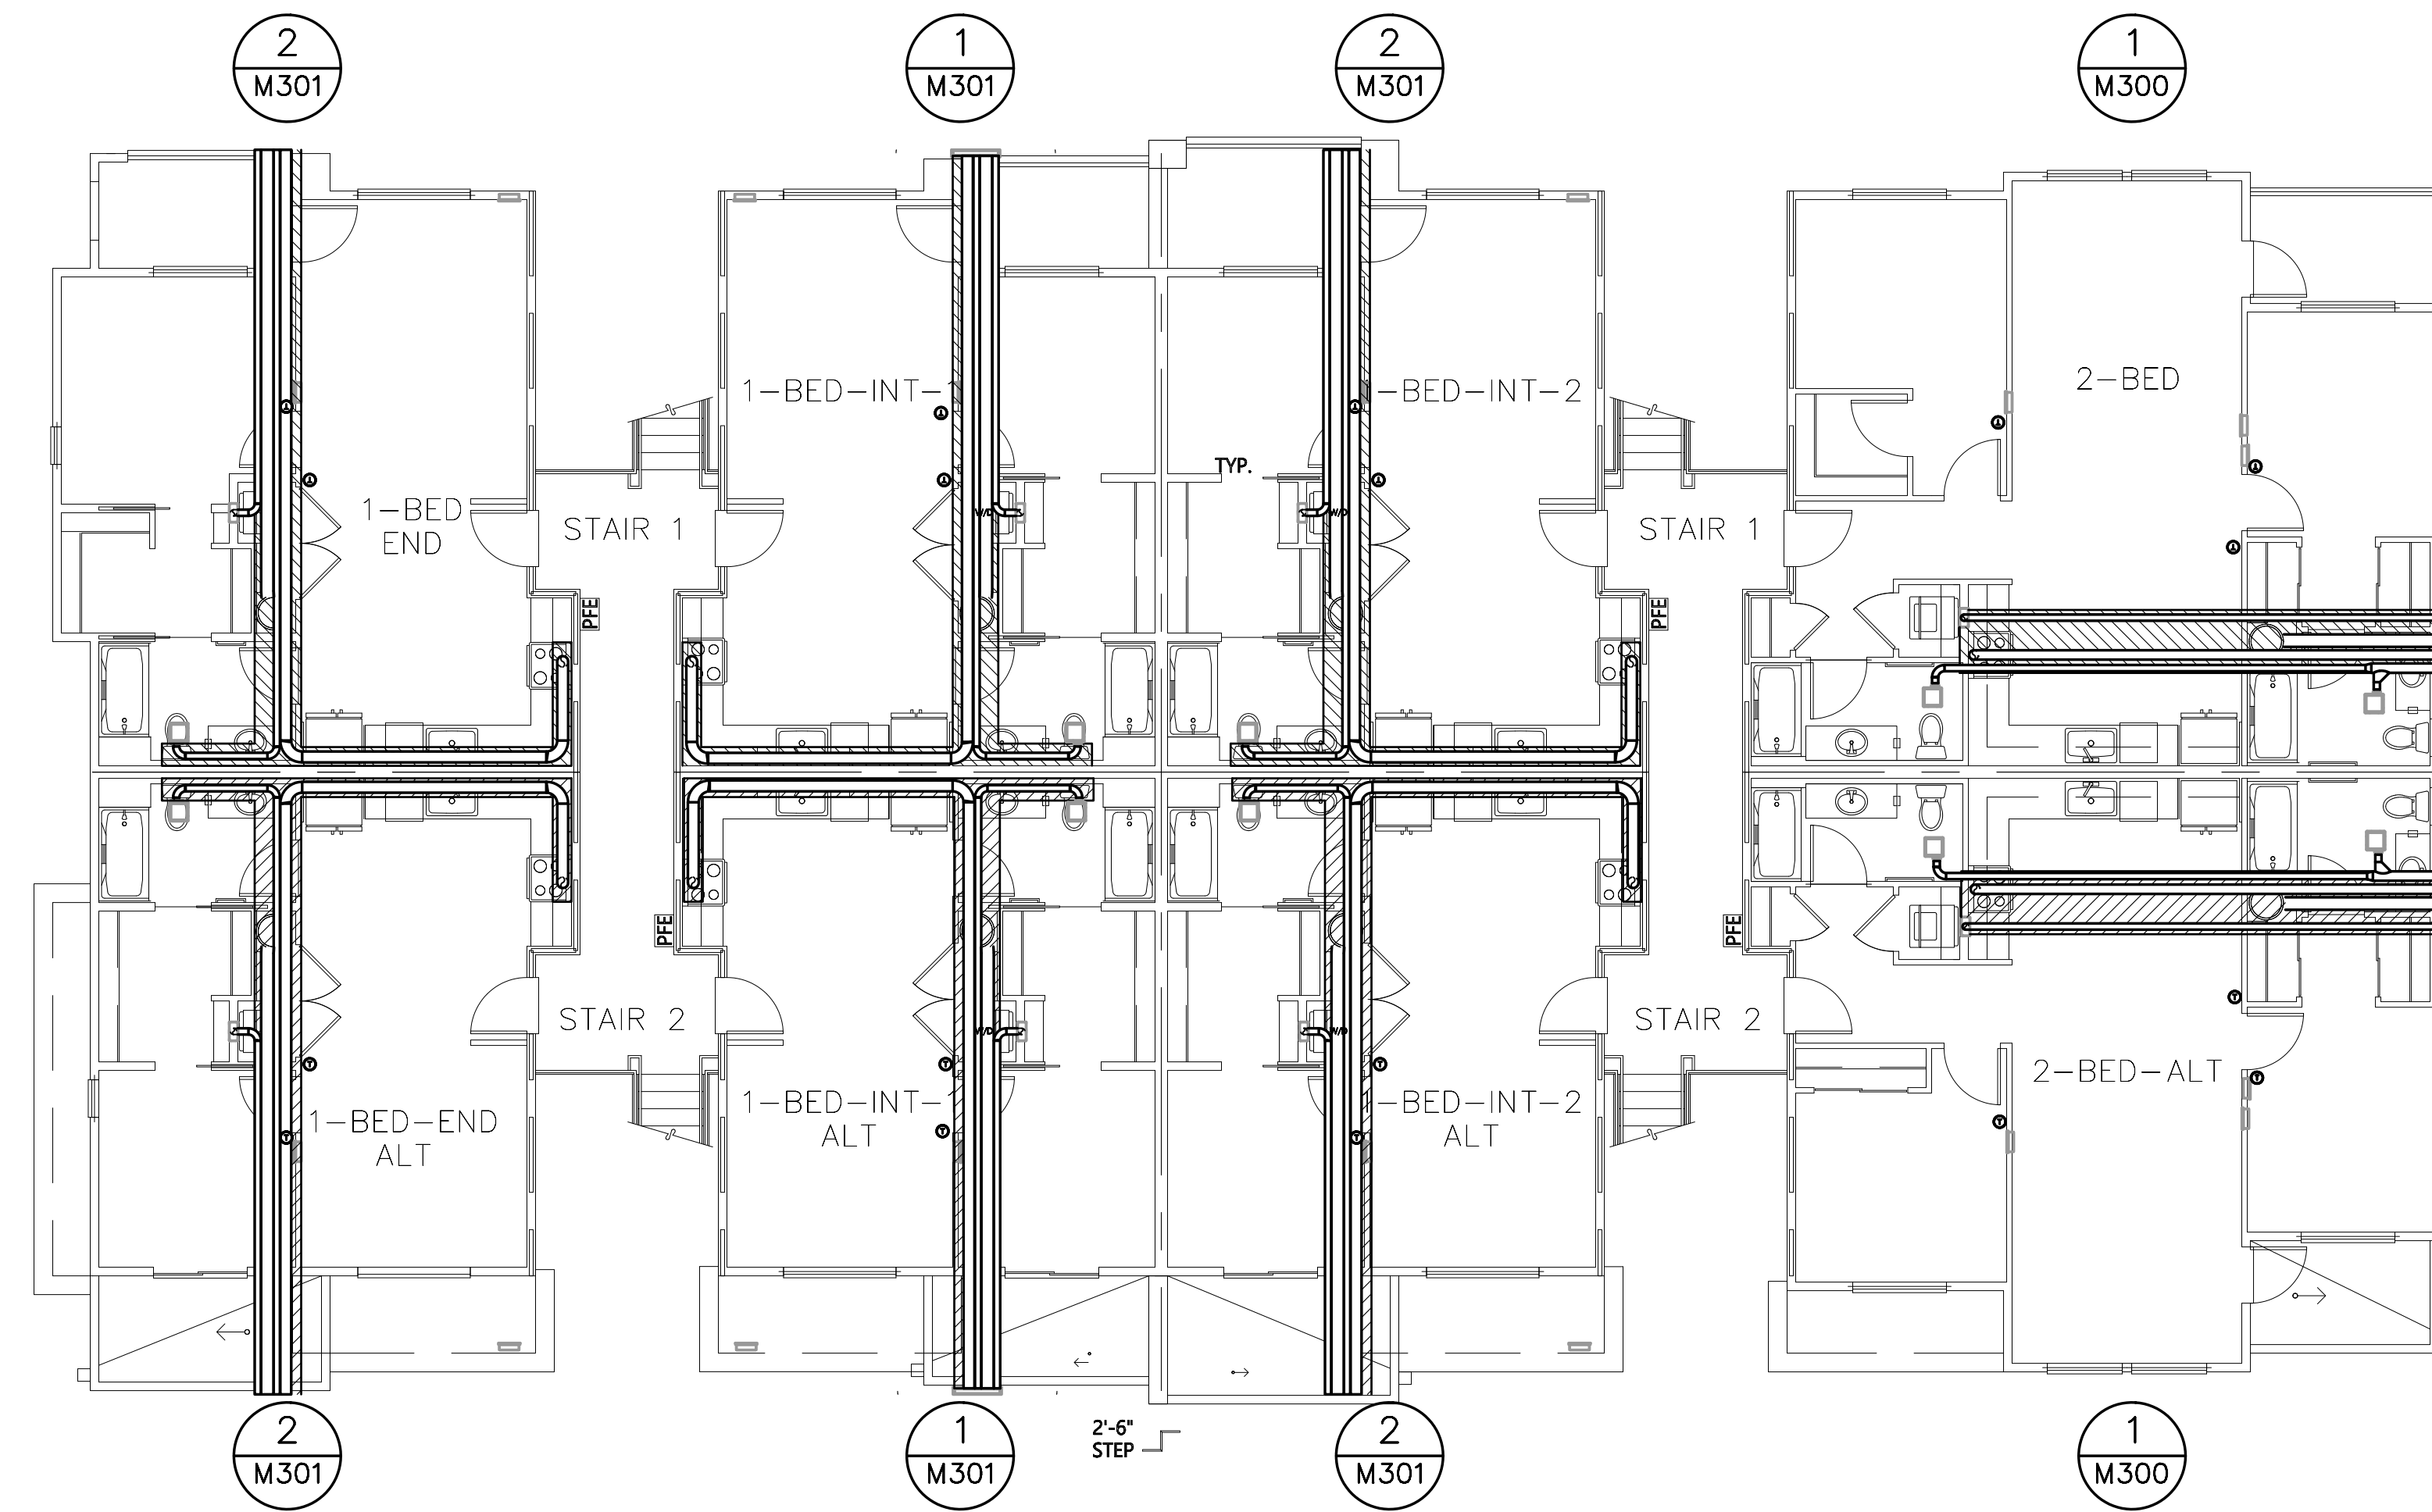

BUILDING A 3rd LEVEL PLAN
 1/8" = 1'-0" 3/4 SPLIT LEVEL, 28-UNIT BUILDING

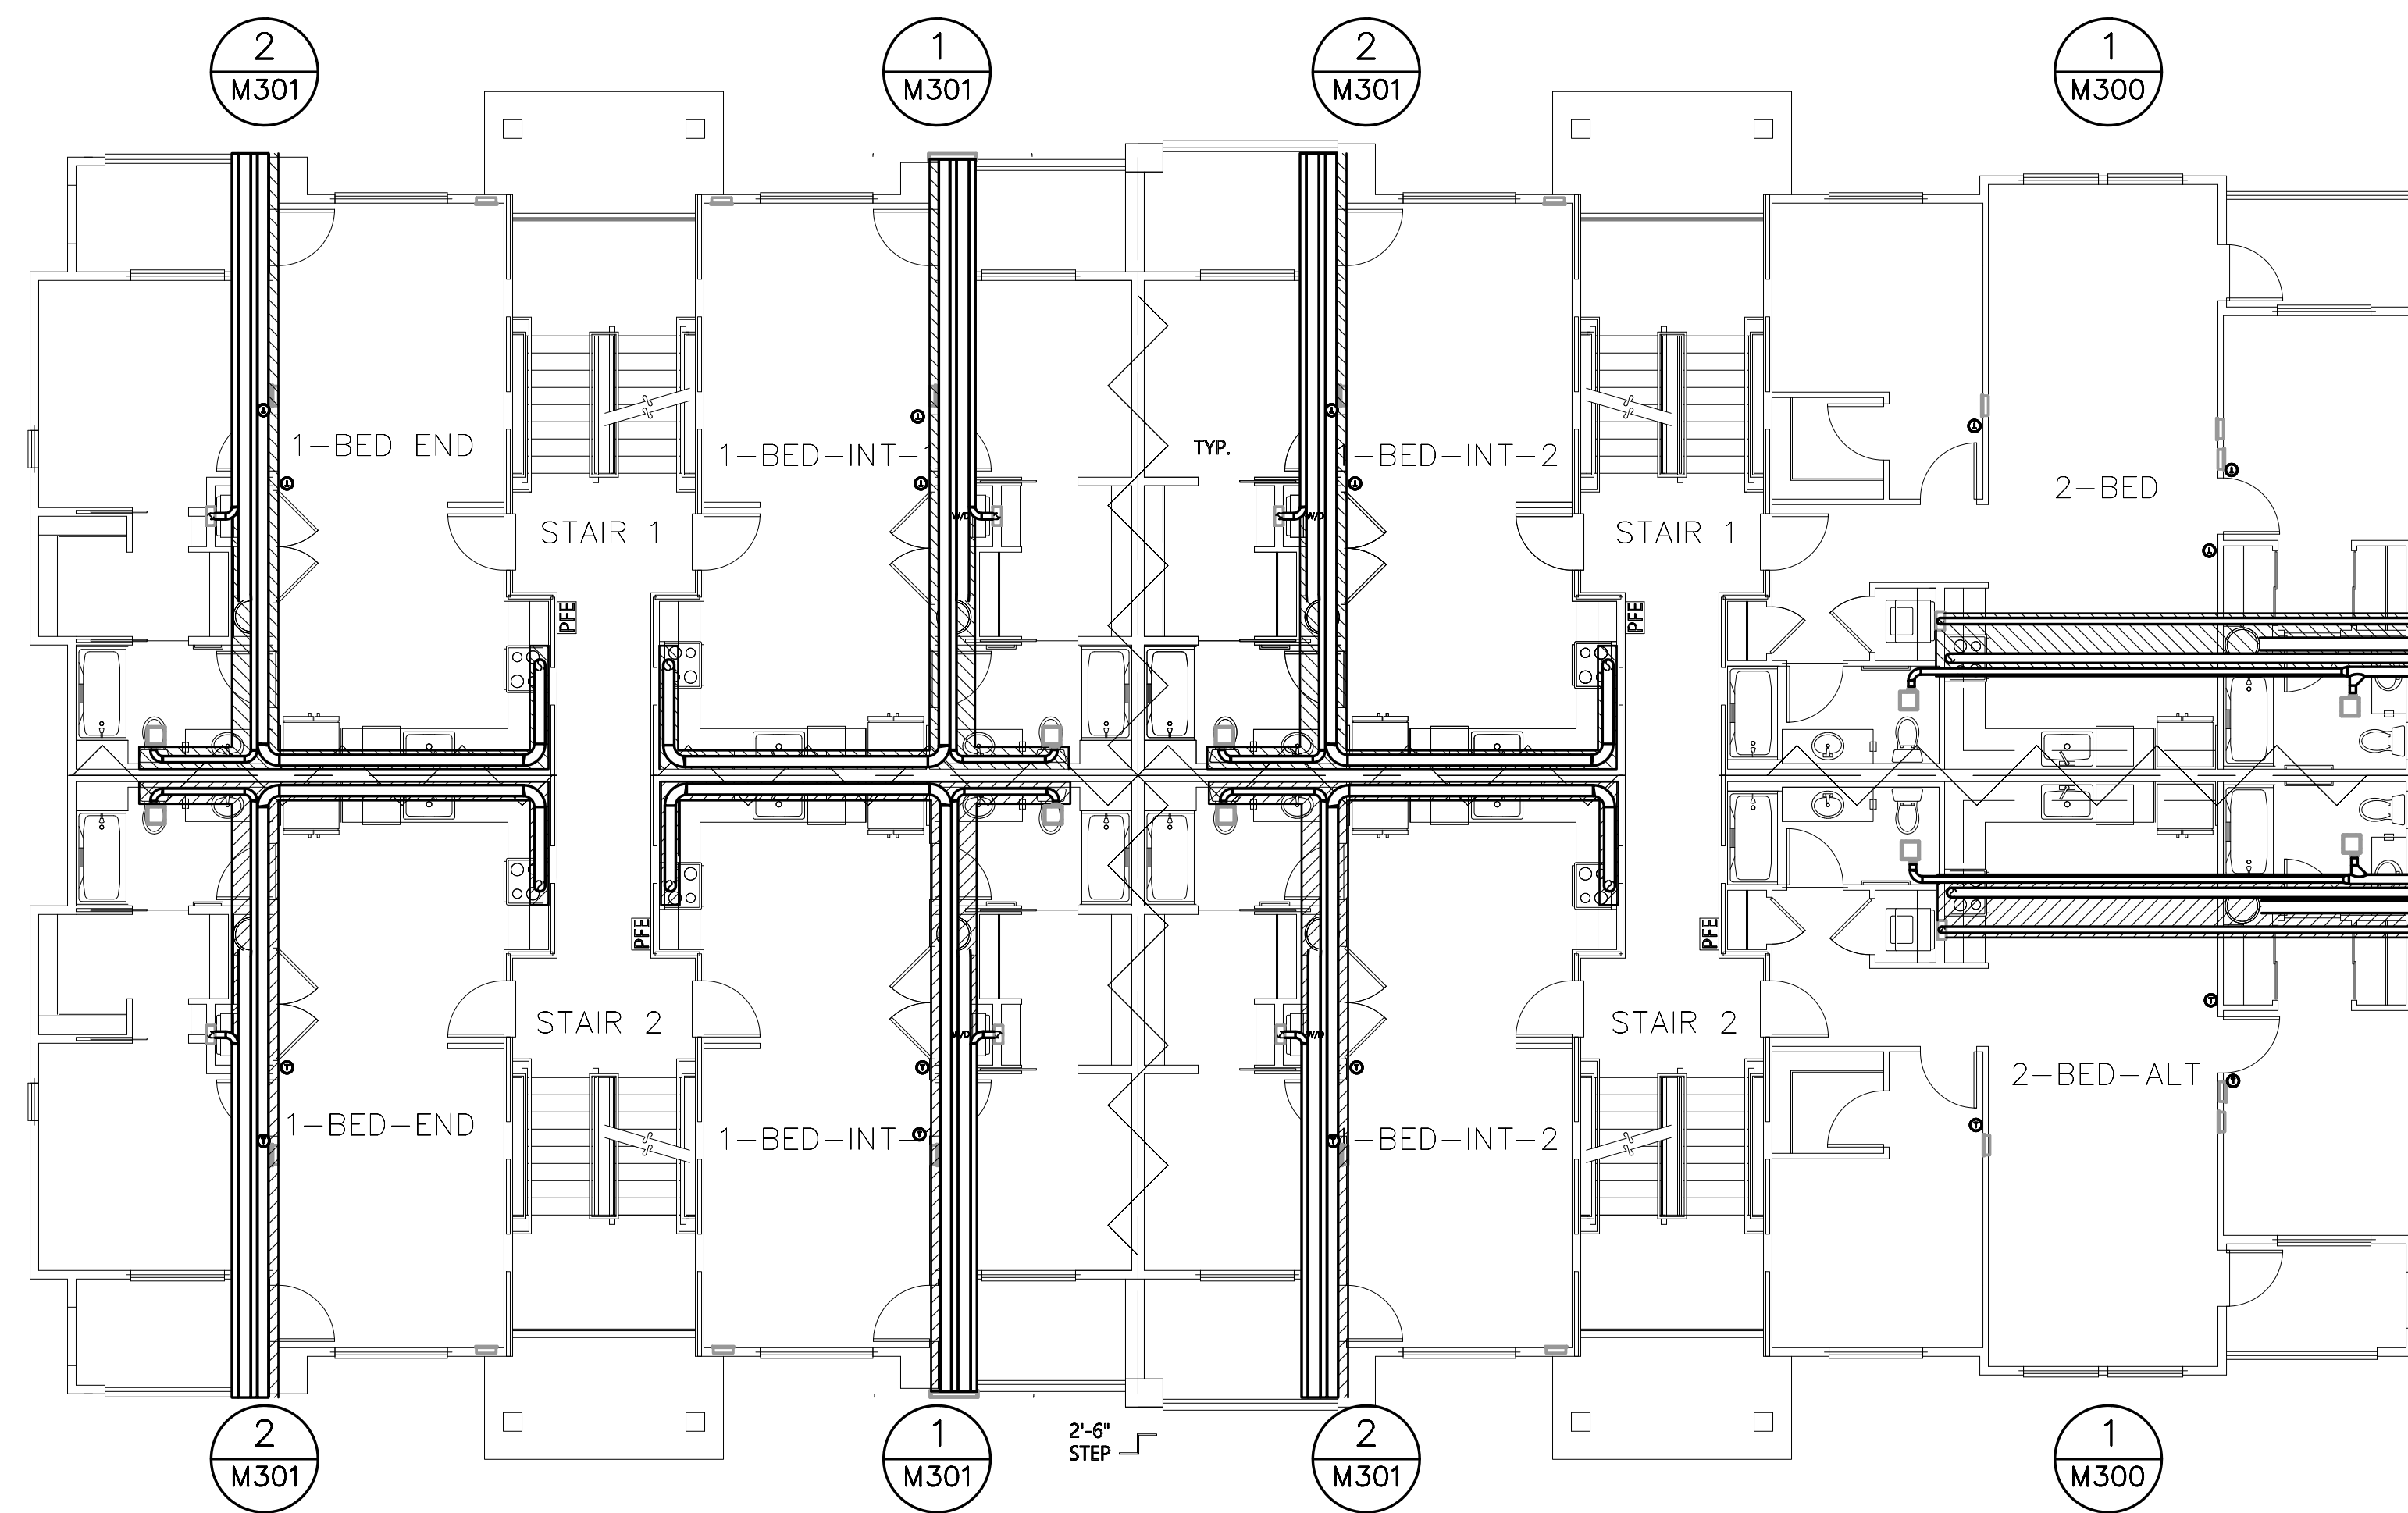


BUILDING A 2nd LEVEL PLAN
 1/8" = 1'-0" 3/4 SPLIT LEVEL, 28-UNIT BUILDING

RESIDENTIAL UNIT NOTES:

1 M300 = REFER TO DWG M300, DETAIL 1.

FOR DUCT SIZES WITHIN THE RESIDENTIAL UNITS, REFER TO THE ENLARGED UNIT PLANS ON DWGS M300-M303.

NO.	DATE	DESCRIPTION	REVISIONS

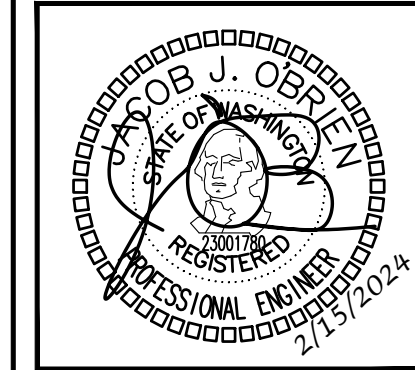


DRAWN:	OP
DESIGNED:	ABE
CHECKED:	ABE
APPROVED:	JOB

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A
 202 27TH AVE SE
 PUYALLUP, WA 98374
 19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343
ROBISON
 ENGINEERING, INC

DATE: 02/15/2024

SHEET TITLE:
 HVAC PLAN -
 2ND & 3RD
 LEVEL

SHEET NO.
M2.1

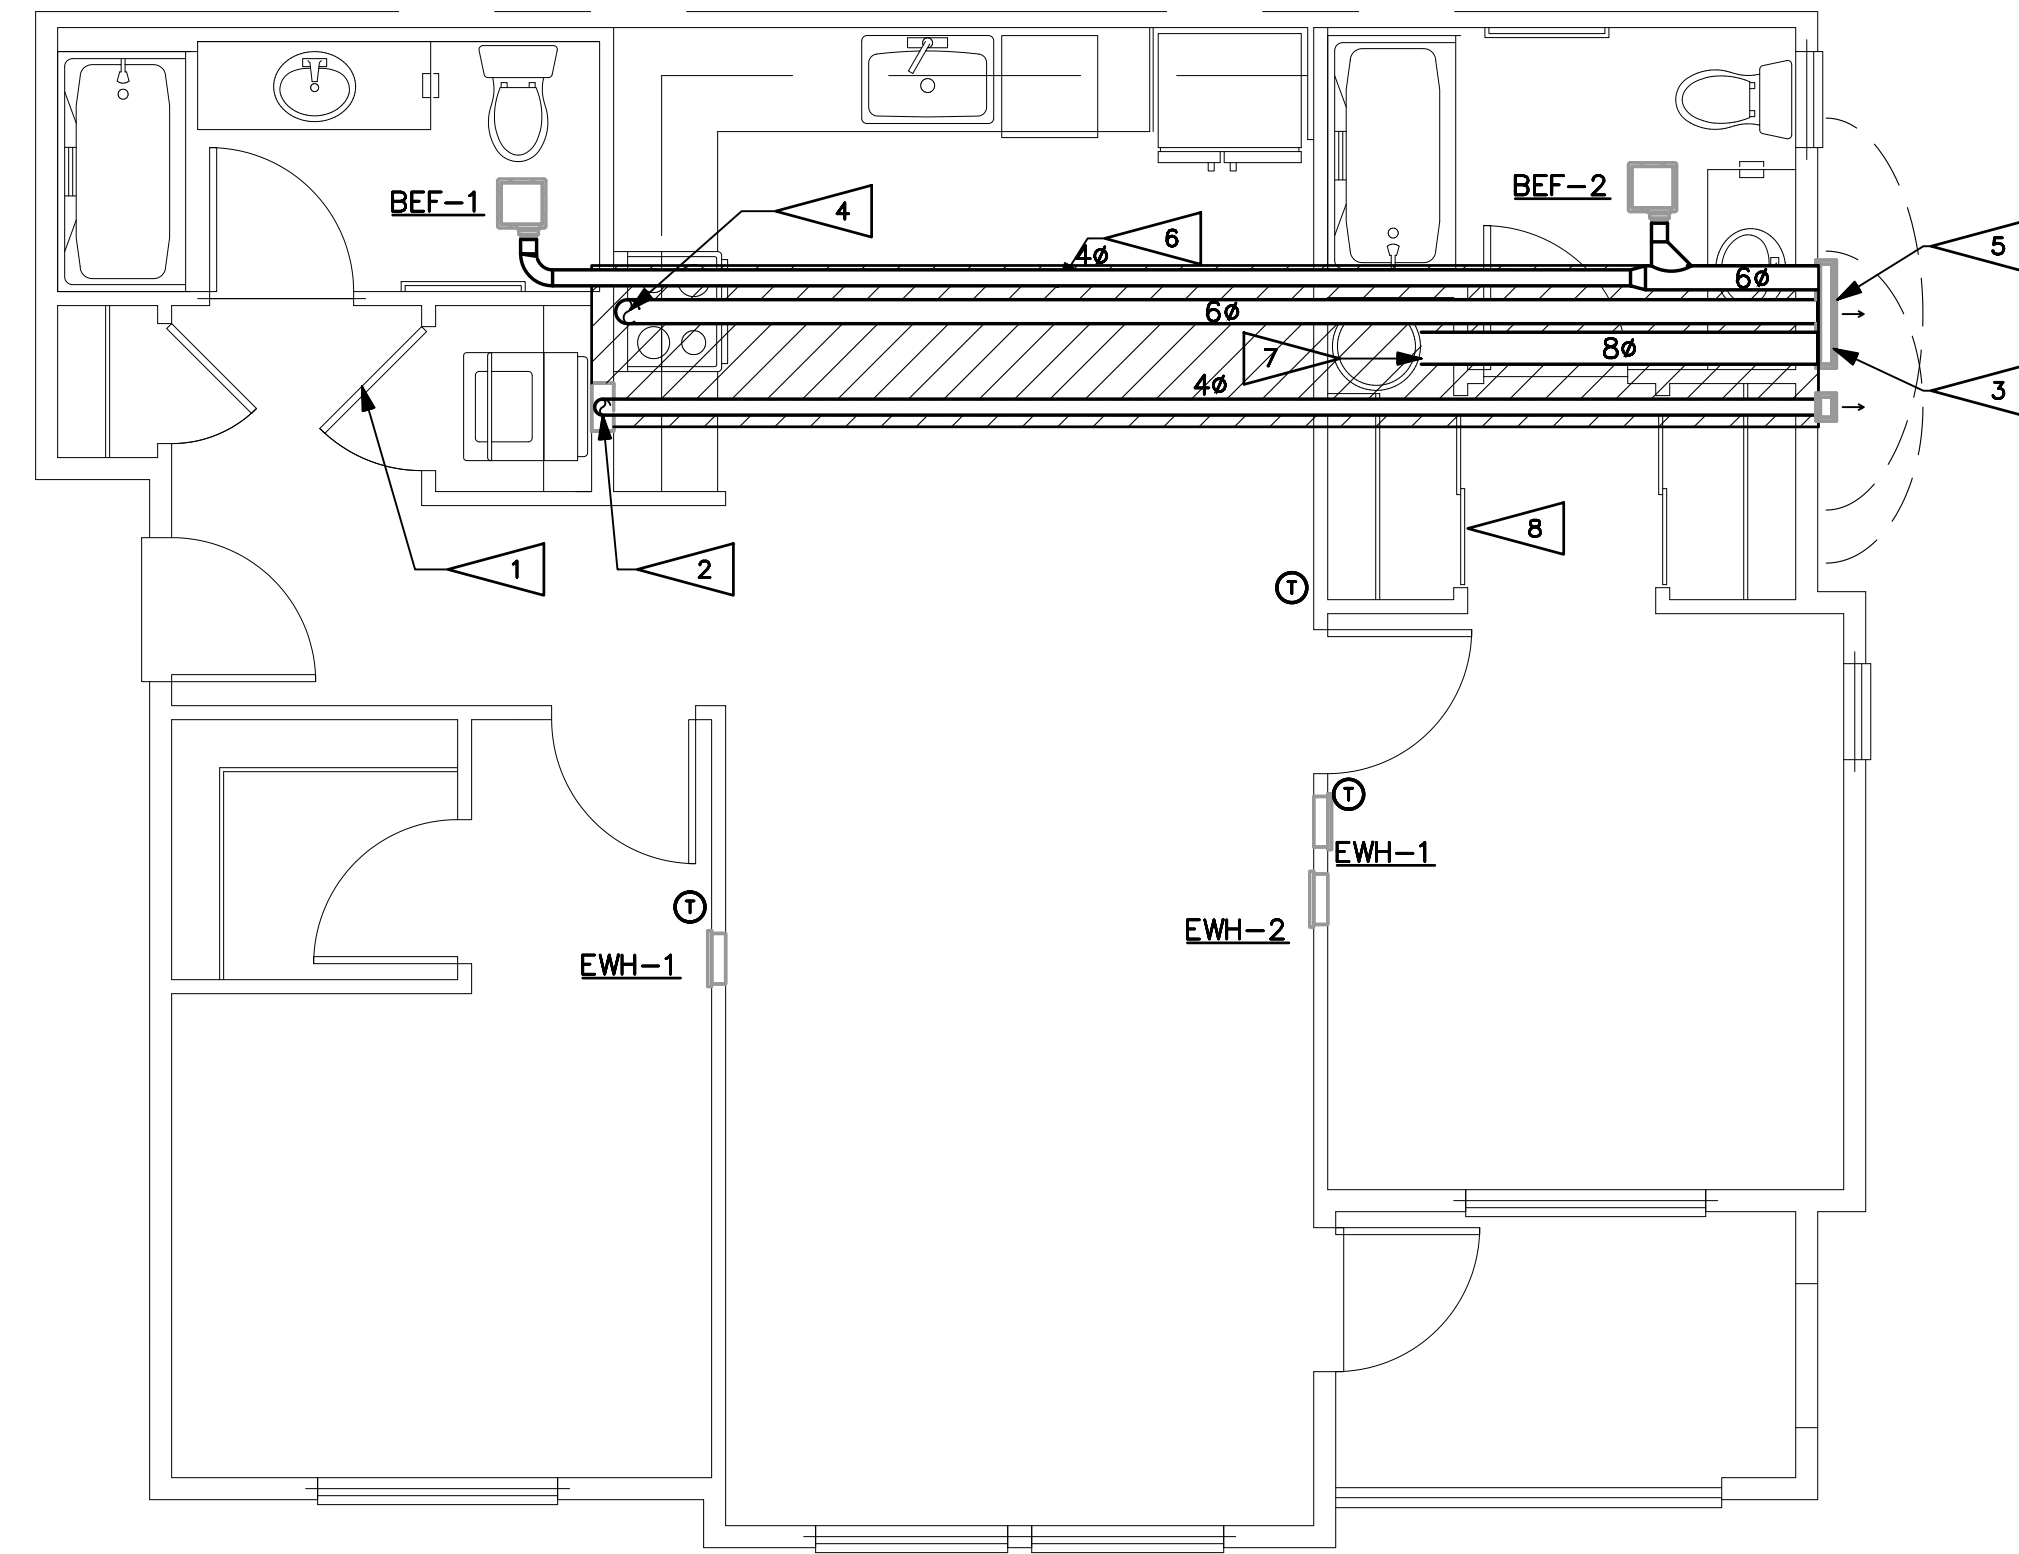


HVAC ENLARGED PLANS

2-BED-ALT-1

SCALE: 1/4" = 1'-0"

1
M300

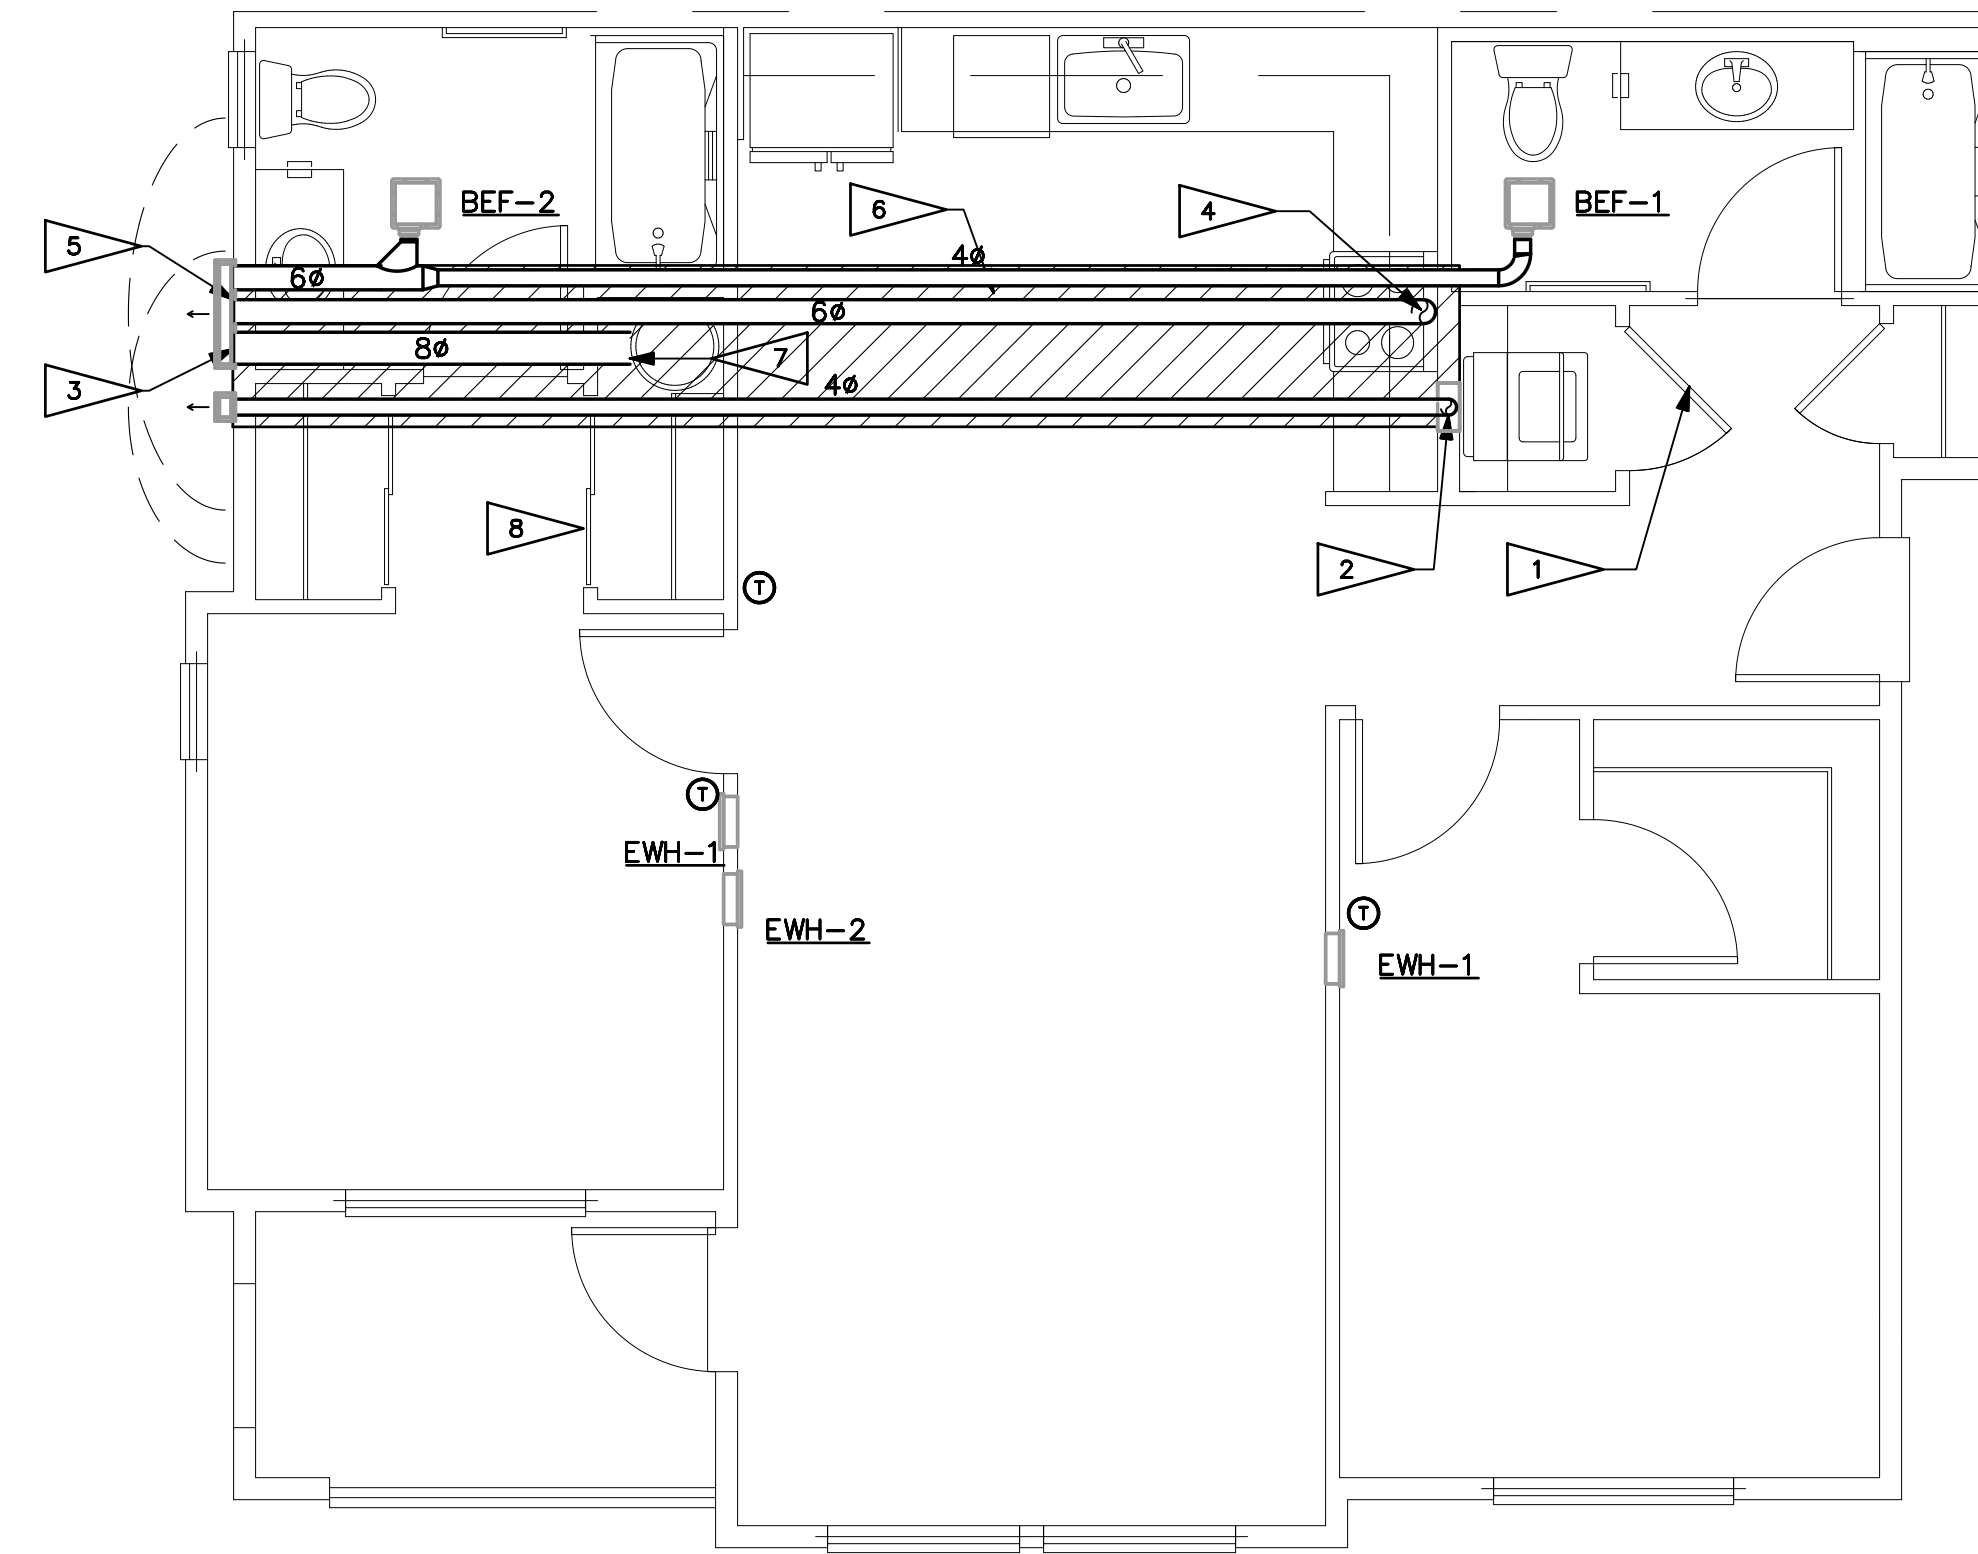

HVAC ENLARGED PLANS

2-BED-ALT-2

SCALE: 1/4" = 1'-0"

2
M300

Provide lengths to all duct work for all floors to identify and verify does not exceed Table 504.8.4.1 for allowable exhaust duct length.

Page M3.0

GENERAL NOTES:



- ENVIRONMENTAL EXHAUST TERMINATIONS: MAINTAIN 3 FOOT SEPARATION FROM PROPERTY LINES AND OPERABLE OPENINGS INTO BUILDING, 10 FEET FROM MECHANICAL AIR INTAKES.
- MOUNT REMOTE THERMOSTATS 48" AFF. PER WSEC C403.4.9, AT LEAST ONE THERMOSTAT SHALL BE PROGRAMMABLE ON A 5-2 SCHEDULE.
- UNDERCUT ALL BATHROOM DOORS BY MINIMUM 1/2" TO ALLOW TRANSFER OF MAKEUP AIR FOR BATHROOM EXHAUST.
- ELECTRIC WALL HEATERS SHALL BE RECESSED IN WALL UNLESS FIRE RATED OR EXTERIOR WALL. FOR HEATERS MOUNTED ON SUCH WALL, PROVIDE SURFACE-MOUNT WALL CAP.
- PROVIDE ACCESSIBLE MANUAL VOLUME DAMPERS AT BRANCHES OR OPPOSED-BLADE DAMPERS AT GRILLES FOR AIR BALANCING PER VOLUME DAMPERS NOTE ON SHEET M0.00.

FLAG NOTES: #

- CLOSETS CONTAINING DRYERS SHALL BE PROVIDED WITH LOUVERED DOOR OR 100 SQ. IN FREE-AREA OPENING ABOVE DOOR. OPENING PROVIDES PATH FOR EXHAUST AIR DURING WASHER OPERATION PER WSMC TABLE 403.3.1.1 NOTE (I) AND MAKEUP AIR DURING DRYER OPERATION PER 504.6.
- 4ø POC TO DRYER. PROVIDE METAL DRYER BOX WHERE DUCT IS ROUTED IN 2x6 FRAMED WALL. REFER TO MANUFACTURER'S INSTALLATION INSTRUCTIONS AND WSMC 504.8.4.1 FOR THE MAXIMUM ALLOWED LENGTH OF THE DRYER VENT. PROVIDE PERMANENT PLACARD OF TYPE PLAC34 SHOWING NET EQUIVALENT LENGTH. DUCT SHALL REMAIN SEPARATE FROM OTHER EXHAUST SYSTEMS UP TO TERMINATION.
- 4" DRYER EXHAUST TERMINATION WALL CAP. PROVIDE BACKDRAFT DAMPER AT TERMINATION. DO NOT INSTALL SCREENS ON DRYER EXHAUST TERMINATIONS. CLEARANCES PER GENERAL NOTE 1.

- POC TO DOMESTIC KITCHEN RANGE HOOD. SEE PLANS FOR SIZE. DUCT SHALL REMAIN SEPARATE FROM OTHER EXHAUST SYSTEMS UP TO TERMINATION.
- DOMESTIC KITCHEN RANGE HOOD EXHAUST TERMINATION WALL CAP WITH SCREEN. PROVIDE BACKDRAFT DAMPER AT TERMINATION. CLEARANCES PER GENERAL NOTE 1.
- LOWERED SOFFIT FOR MECHANICAL EQUIPMENT.
- 8ø POC FOR HEAT PUMP WATER HEATER EXHAUST.
- CLOSETS CONTAINING WATER HEATERS SHALL BE PROVIDED WITH MINIMUM 3/4" UNDERCUT.

NO.	DATE	DESCRIPTION	REVISIONS

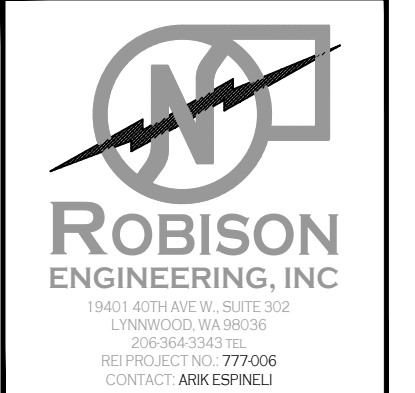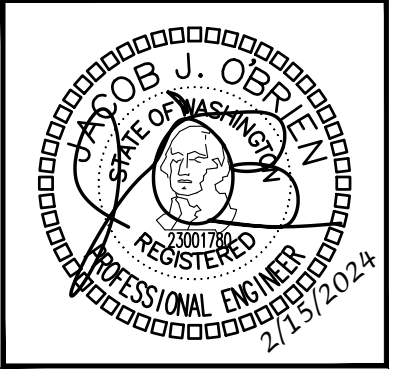

DRAWN:	OP
DESIGNED:	ABE
CHECKED:	ABE
APPROVED:	JOB

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A
202 27TH AVE SE
PUYALLUP, WA 98374


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 864-3343

ROBISON
ENGINEERING, INC

DATE: 02/15/2024

SHEET TITLE:
HVAC
ENLARGED
PLANS

SHEET NO.
M3.0

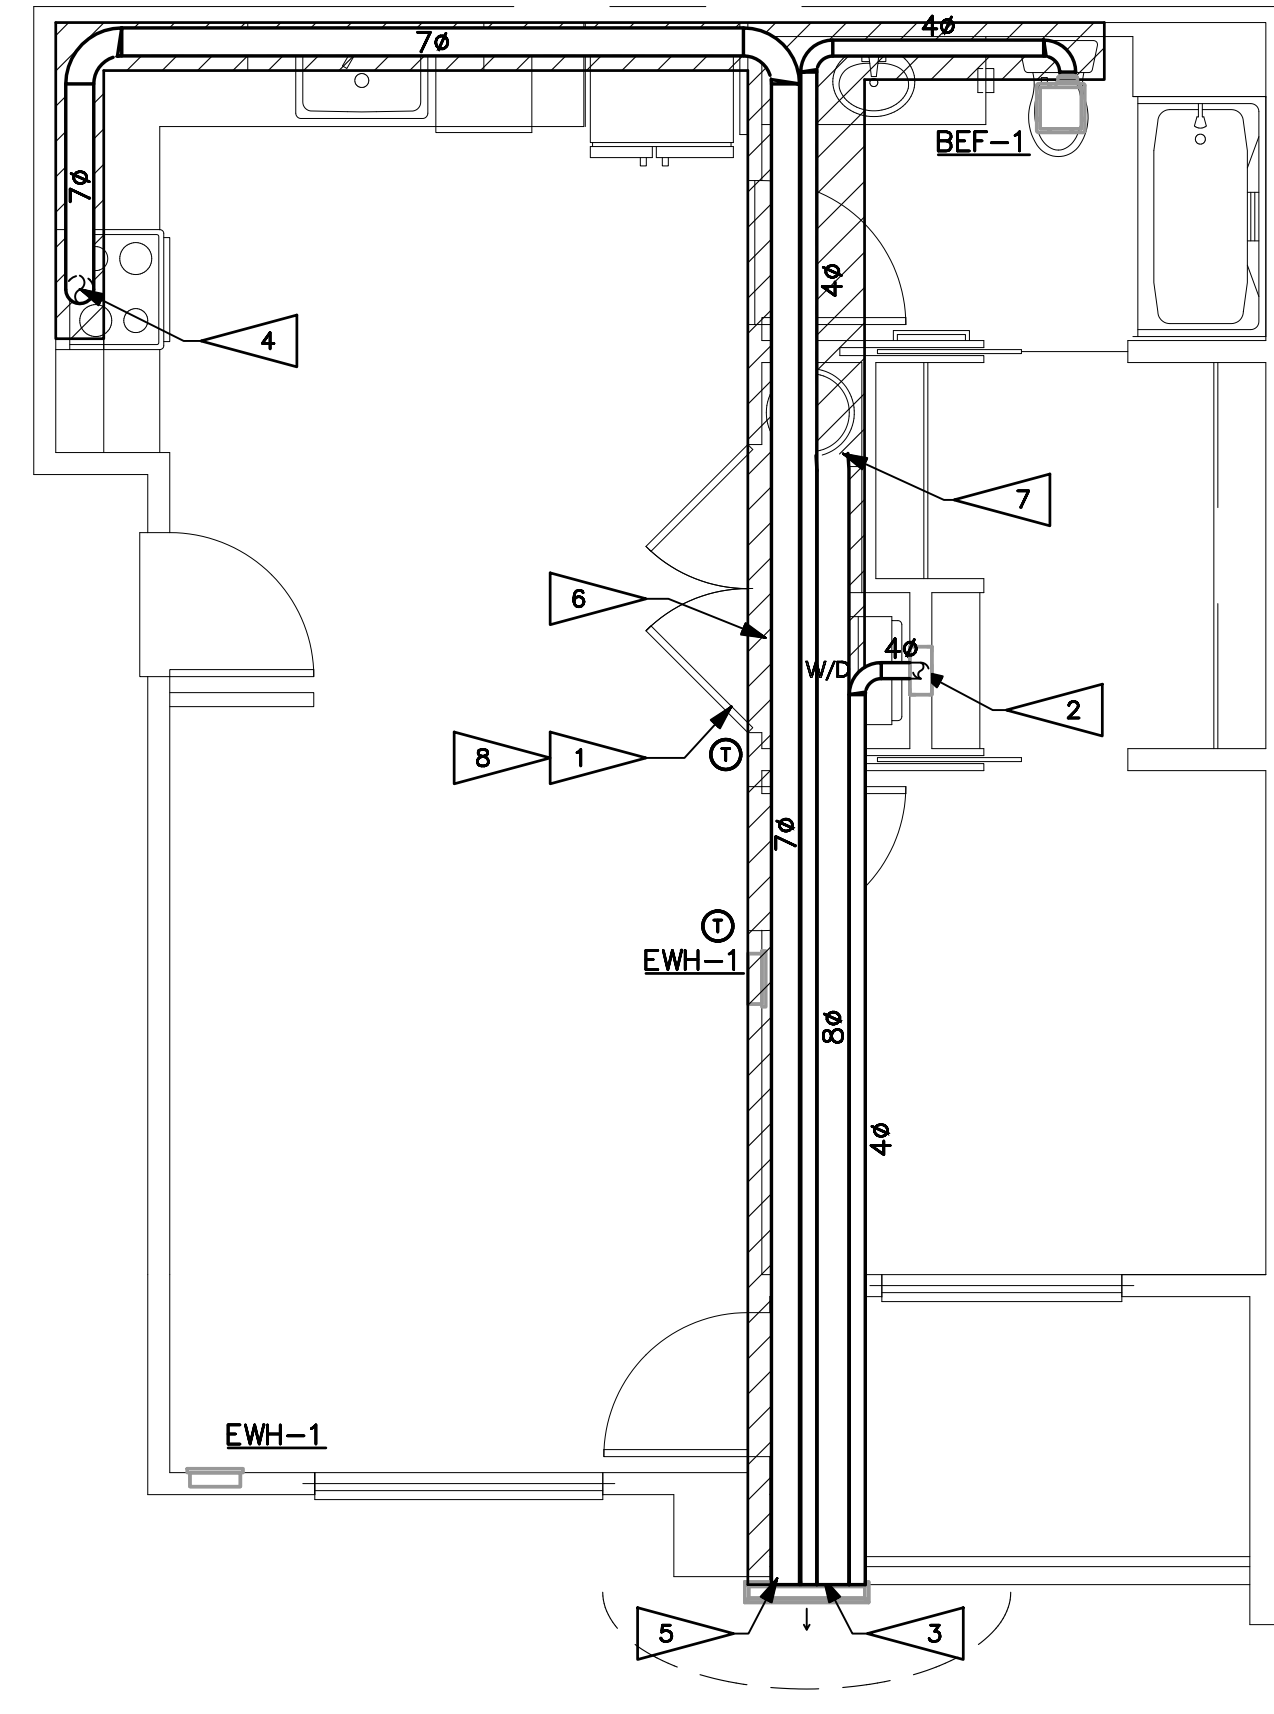


HVAC ENLARGED PLANS

1-BED-INT-1

SCALE: 1/4" = 1'-0"

1
M301

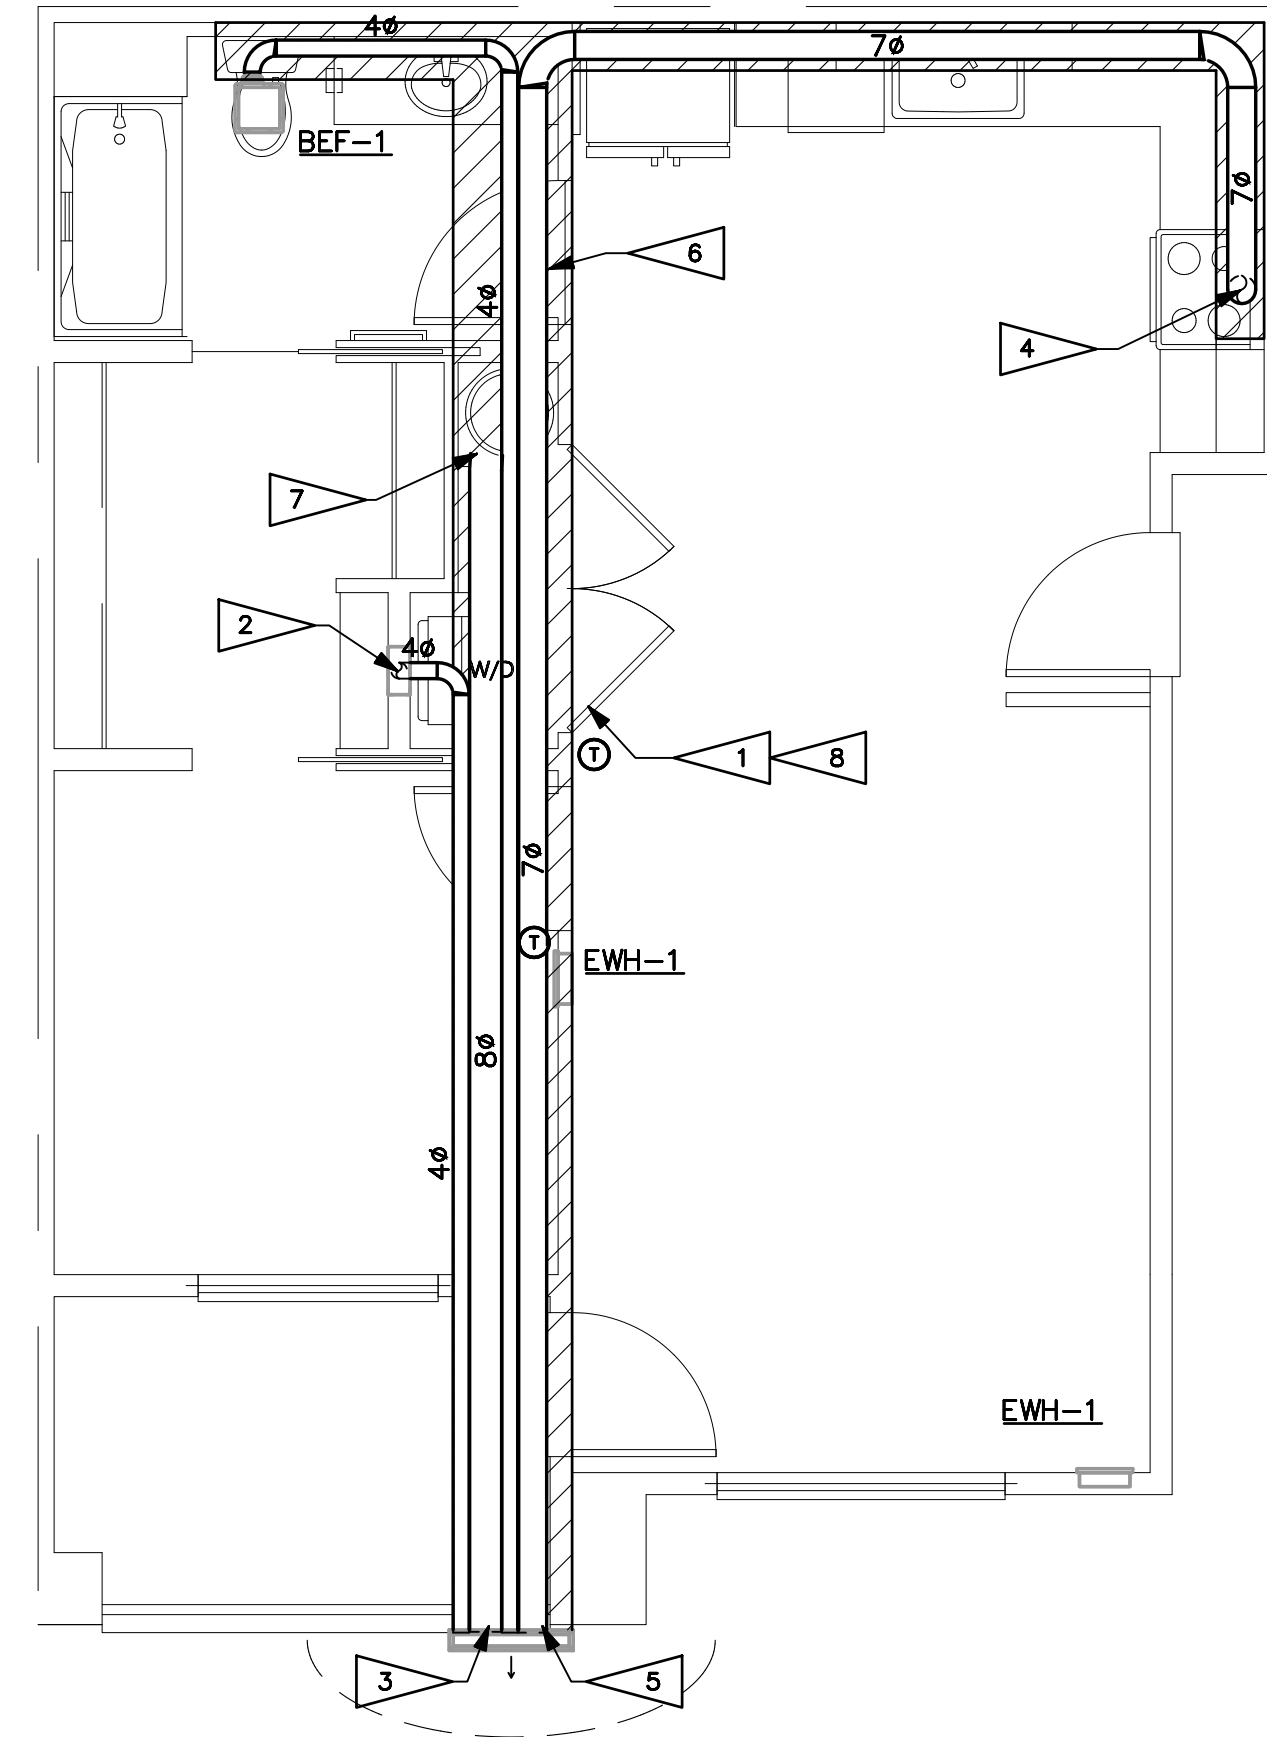


HVAC ENLARGED PLANS

1-BED-INT-2

SCALE: 1/4" = 1'-0"

2
M301

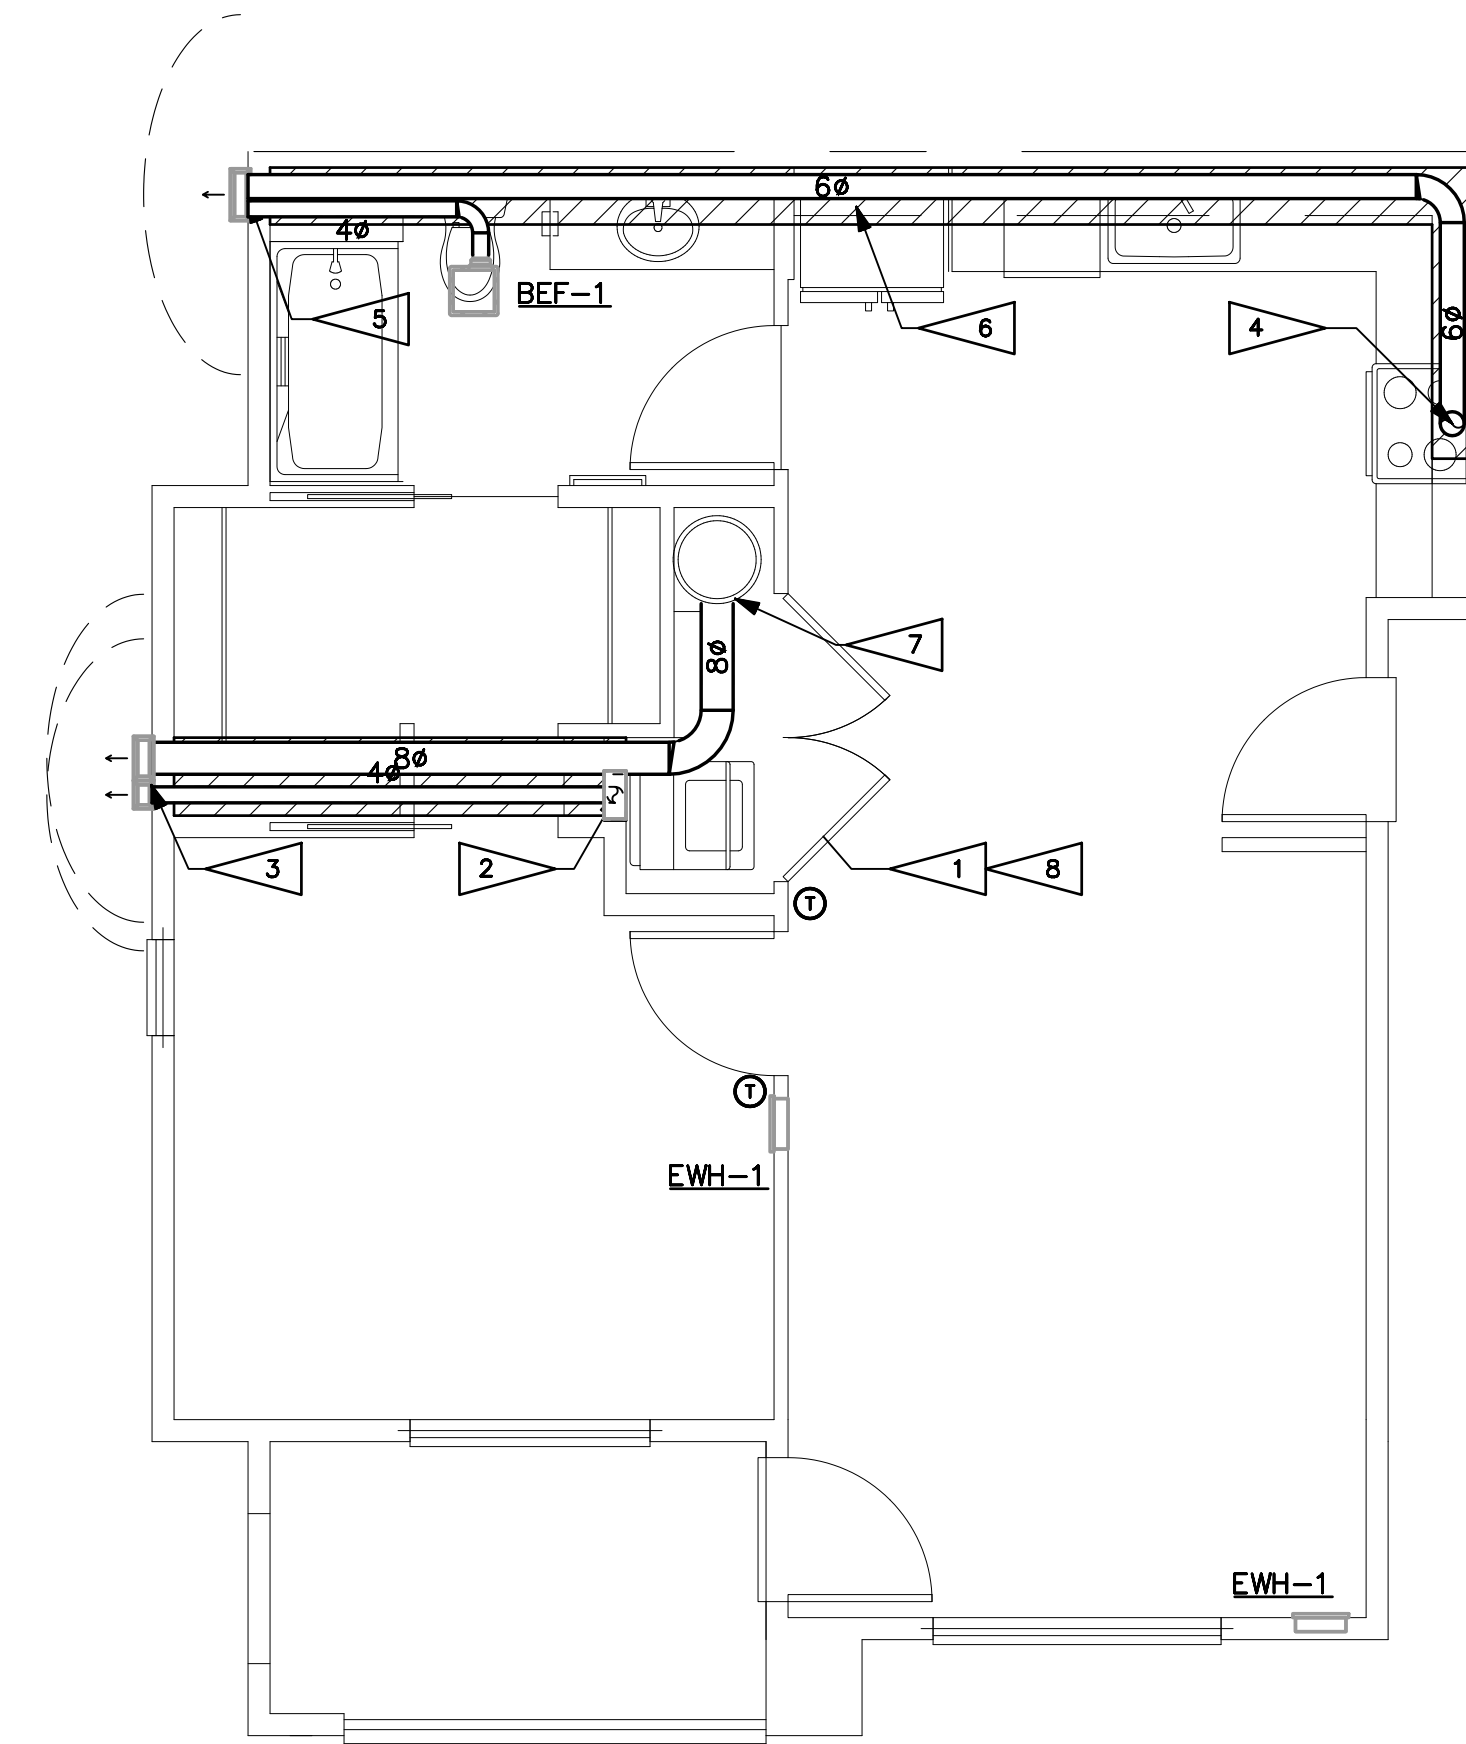

HVAC ENLARGED PLANS

1-BED-END

SCALE: 1/4" = 1'-0"

3
M301

GENERAL NOTES:

- ENVIRONMENTAL EXHAUST TERMINATIONS: MAINTAIN 3 FOOT SEPARATION FROM PROPERTY LINES AND OPERABLE OPENINGS INTO BUILDING, 10 FEET FROM MECHANICAL AIR INTAKES.
- MOUNT REMOTE THERMOSTATS 48" AFF. PER WSEC C403.4.9, AT LEAST ONE THERMOSTAT SHALL BE PROGRAMMABLE ON A 5-2 SCHEDULE.
- UNDERCUT ALL BATHROOM DOORS BY MINIMUM 1/2" TO ALLOW TRANSFER OF MAKEUP AIR FOR BATHROOM EXHAUST.
- ELECTRIC WALL HEATERS SHALL BE RECESSED IN WALL UNLESS FIRE RATED OR EXTERIOR WALL. FOR HEATERS MOUNTED ON SUCH WALL, PROVIDE SURFACE-MOUNT WALL CAN.
- PROVIDE ACCESSIBLE MANUAL VOLUME DAMPERS AT BRANCHES OR OPPOSED-BLADE DAMPERS AT GRILLES FOR AIR BALANCING PER VOLUME DAMPERS NOTE ON SHEET M0.00.

FLAG NOTES: #



- CLOSETS CONTAINING DRYERS SHALL BE PROVIDED WITH LOUVERED DOOR OR 100 SQ. IN FREE-AREA OPENING ABOVE DOOR. OPENING PROVIDES PATH FOR EXHAUST AIR DURING WASHER OPERATION PER WSMC TABLE 403.3.1.1 NOTE (I) AND MAKEUP AIR DURING DRYER OPERATION PER 504.6.
- 4ø POC TO DRYER. PROVIDE METAL DRYER BOX WHERE DUCT IS ROUTED IN 2x6 FRAMED WALL. REFER TO MANUFACTURER'S INSTALLATION INSTRUCTIONS AND WSMC 504.8.4.1 FOR THE MAXIMUM ALLOWED LENGTH OF THE DRYER VENT. PROVIDE PERMANENT PLACARD OF TYPE PLAC34 SHOWING NET EQUIVALENT LENGTH. DUCT SHALL REMAIN SEPARATE FROM OTHER EXHAUST SYSTEMS UP TO TERMINATION.
- 4" DRYER EXHAUST TERMINATION WALL CAP. PROVIDE BACKDRAFT DAMPER AT TERMINATION. DO NOT INSTALL SCREENS ON DRYER EXHAUST TERMINATIONS. CLEARANCES PER GENERAL NOTE 1.

- POC TO DOMESTIC KITCHEN RANGE HOOD. SEE PLANS FOR SIZE. DUCT SHALL REMAIN SEPARATE FROM OTHER EXHAUST SYSTEMS UP TO TERMINATION.
- DOMESTIC KITCHEN RANGE HOOD EXHAUST TERMINATION WALL CAP WITH SCREEN. PROVIDE BACKDRAFT DAMPER AT TERMINATION. CLEARANCES PER GENERAL NOTE 1.
- LOWERED SOFFIT FOR MECHANICAL EQUIPMENT.
- 8ø POC FOR HEAT PUMP WATER HEATER EXHAUST.
- CLOSETS CONTAINING WATER HEATERS SHALL BE PROVIDED WITH MINIMUM 3/4" UNDERCUT.

Provide lengths to all duct work for all floors to identify and verify does not exceed Table 504.8.4.1 for allowable exhaust duct length.

Page M3.1

NO.	DATE	DESCRIPTION	REVISIONS

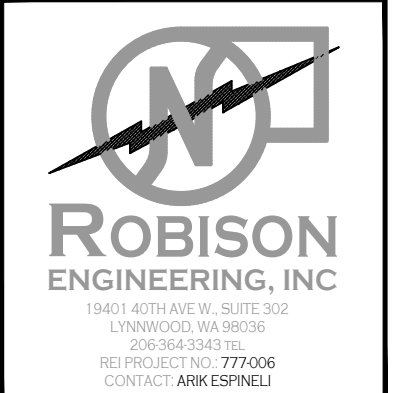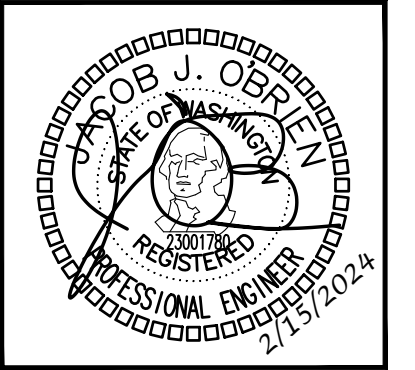

DRAWN:	OP
DESIGNED:	ABE
CHECKED:	ABE
APPROVED:	JOB

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A
202 27TH AVE SE
PUYALLUP, WA 98374

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 364-3343

ROBISON
ENGINEERING, INC.

DATE: 02/15/2024

SHEET TITLE:
HVAC
ENLARGED
PLANS

SHEET NO.
M3.1

SYMBOLS

ABBREVIATIONS

GENERAL NOTES


GENERAL

LIGHT LINE INDICATES NON-ELECTRICAL OR BACKGROUND (THIS IS NOT CONTRACTUAL DEFINITION OF WORK)

HEAVY LINE INDICATES NEW WORK (THIS IS NOT CONTRACTUAL DEFINITION OF WORK)

DETAIL IDENTIFICATION

SYMBOL



FLAG NOTE



REVISION NOTE



REVISION DEFINITION, AREA ENCIRCLED CONTAINS DRAWING CHANGES MADE SUBSEQUENT TO PREVIOUS ISSUE

SWITCHES



SWITCH, SINGLE POLE; WITH SWITCHING SUBSCRIPT



OCCUPANCY SENSOR SWITCH




SWITCH, SINGLE POLE; WITH SWITCHING SUBSCRIPT "D" INDICATES WALLBOX DIMMER



CEILING MOUNTED OCCUPANCY SENSOR



SWITCH, TIMER.



SWITCH, THREE WAY.

RECEPTACLES



SINGLE RECEPTACLE



DUPLEX RECEPTACLE: WALL MOUNTED, +18" AFF




CONTROLLED AND NON CONTROLLED DUPLEX RECEPTACLE (SPLIT WIRED RECEPTACLE)




DUPLEX RECEPTACLE - ABOVE DUPLEX



DUPLEX GFCI ABOVE COUNTER



DUPLEX RECEPTACLE, WITH HEIGHT ABOVE FINISHED FLOOR INDICATED



CEILING MOUNTED DUPLEX RECEPTACLE



DOUBLE DUPLEX RECEPTACLE: WALL MOUNTED, +18" AFF



FLOOR BOX ONE DUPLEX RECEPTACLE






FLOOR BOX ONE DUPLEX RECEPTACLE + ONE DATA



FLOOR BOX ONE DUPLEX RECEPTACLE + ONE DATA + ONE VOICE



SPECIAL PURPOSE RECEPTACLE, AS NOTED



SIGNAL/COMMUNICATION



DATA OUTLET: WALL MOUNTED @ +18" AFF U.O.N.



TELEPHONE/DATA OUTLET: WALL MOUNTED @ +18" AFF U.O.N.




TELEVISION OUTLET: WALL MOUNTED @ +18" AFF U.O.N.


POWER



PANELBOARD



NON-FUSED DISCONNECT SWITCH (WP = NEMA 3R WHERE APPROPRIATE)



FUSED DISCONNECT SWITCH



MOTOR CONNECTION (EQUIPMENT NAME, HORSEPOWER, VOLTAGE, AND PHASE INDICATED)



EQUIPMENT CONNECTION (EQUIPMENT NAME, LOAD, VOLTAGE, AND PHASE INDICATED)



TRANSFORMER, DRY TYPE, SHOWN TO SCALE




KW METER AND BASE




TRANSFORMER, DRY TYPE, SHOWN TO SCALE



KW METER AND BASE



KW METER AND BASE



KW METER AND BASE



KW METER AND BASE

FIRE ALARM SYSTEM



FIRE ALARM SYSTEM CONTROL PANEL



FIRE ALARM SYSTEM PULL STATION




FIRE ALARM SYSTEM STROBE/SPEAKER




FIRE ALARM PHOTOELECTRIC SMOKE DETECTOR AND SPEAKER.



FIRE ALARM COMBINATION PHOTOELECTRIC SMOKE DETECTOR, CARBON MONOXIDE DETECTOR, AND SPEAKER, GUESTROOM.



CARBON MONOXIDE DETECTOR.



ELECTRO-MAGNETIC DOOR HOLDER



DUCT SMOKE DETECTOR



DUCT SMOKE DETECTOR



DUCT SMOKE DETECTOR



DUCT SMOKE DETECTOR



DUCT SMOKE DETECTOR

ABBREVIATIONS

Table of electrical abbreviations including AMPERE, ALTERNATING CURRENT, ABOVE COUNTER, ALUMINUM, AMERICAN WIRE GAUGE, BREAKER, BUILDING, COIL OF CONDUIT, etc.

GENERAL

- 1. PROVIDE ELECTRICAL INSTALLATION IN ACCORDANCE WITH THE GOVERNING ELECTRICAL CODE, LOCAL CODES, ORDINANCES AND REQUIREMENTS OF UTILITY COMPANIES FURNISHING SERVICES TO INSTALLATION.

MATERIALS AND METHODS

- 1. PROVIDE RACEWAY AND WIRING ROUTED CONCEALED WITHIN BUILDING STRUCTURE WHERE POSSIBLE. WHERE RACEWAY CANNOT BE CONCEALED, IT SHALL BE INSTALLED PER PROJECT MANAGER'S DIRECTION.

- 7. WIRING: PROVIDE MINIMUM #10 AWG COPPER CONDUCTOR SIZE IN 120V BRANCH CIRCUIT RUNS OVER 75' IN LENGTH.

SITE ELECTRICAL

- 1. TRENCHING: COORDINATE ALL TRENCHING WORK WITH OTHER UTILITY LOCATIONS AND DRAINAGE TRENCHES.

NEUTRALS

- 1. AT CONTRACTOR'S OPTION, NEUTRALS MAY BE SHARED ON COMBINED HOMERUNS UNLESS THE CIRCUIT HAS A GFCI BREAKER, AN ISOLATED GROUND, OR IS FROM A PANEL WITH TVSS PROTECTION.

LIGHTING

- 1. PROVIDE LIGHT FIXTURES WITH PROPER FITTING FLANGES, MOUNTING SUPPORTS, AND ACCESSORY ITEMS, UL LISTED FOR CONDITIONS OF USE.

LOW VOLTAGE LIGHTING

- 1. PROVIDE LOW VOLTAGE TRANSFORMERS IN NEARBY ACCESSIBLE CEILING SPACE.

LIGHTING CONTROL

- 1. THE MAXIMUM LIGHTING POWER THAT MAY BE CONTROLLED FROM A SINGLE SWITCH OR AUTOMATIC CONTROL SHALL NOT EXCEED THAT WHICH IS PROVIDED BY A TWENTY AMPERE CIRCUIT LOADED TO NOT MORE THAN EIGHTY PERCENT.

GENERAL REQUIREMENTS

- 1. DRAWINGS ARE DIAGRAMMATIC, SHOWING THE GENERAL LOCATION, TYPE, LAYOUT, AND EQUIPMENT REQUIRED.

CONTRACTOR SUBSTITUTIONS & REVISIONS

- 1. PLEASE SUBMIT PROPOSALS FOR SUBSTITUTIONS OR REVISIONS FOR REVIEW AND APPROVAL PRIOR TO ORDERING MATERIAL OR DOING WORK.

PRE-CON MEETING NOTES

CONTRACTORS SHALL ATTEND A PRE-CONSTRUCTION MEETING WITH THE ENGINEER FOR THE PURPOSE OF REVIEWING THE WORK PRIOR TO ORDERING ANY EQUIPMENT OR PERFORMING ANY WORK.

THE FOLLOWING TRADES SHALL BE REPRESENTED FOR THE MINIMUM TIME INDICATED:

Table listing trades and minimum time: MECHANICAL SHEET METAL 4 HOURS, PLUMBING/PIPING 4 HOURS, ELECTRICAL 4 HOURS, SPRINKLER 2 HOURS, GENERAL CONTRACTOR ALL SESSIONS.

DRAWING INDEX

Table with columns for DWG, DESCRIPTION, DD SET, PERMIT REVIEW SET, 10/06/23, PERMIT SET, 02/15/24.

Separate electrical permit is required with Washington State Department of Labor & Industries.

https://lni.wa.gov/licensing-permits/electrical/electrical-perm-its-fees-and-inspections or Licensing information: Call 1-800-647-0982

Revisions table with columns for NO., DATE, DESCRIPTION.

Professional Engineer Seal for Mark Steinkamp, License No. 021524, Robison Engineering, Inc.

Approval table with columns for DRAWN, DESIGNED, CHECKED, APPROVED.

Project information: BRADLEY HEIGHTS APARTMENTS BUILDING A, 27TH AVE SE AND 5TH ST SE PUYALLUP, WA. Includes Robison Engineering, Inc. logo and contact info.

APPLICABLE CODES

THE FOLLOWING PROJECT DESIGN IS BASED ON THE FOLLOWING CODES:

- 2020 NATIONAL ELECTRICAL CODE (NEC)
- 2018 WASHINGTON STATE ENERGY CODE (WSEC)
- 2018 INTERNATIONAL BUILDING CODE (IBC) & WASHINGTON STATE AMENDMENTS
- 2018 INTERNATIONAL FIRE CODE (IFC) & WASHINGTON STATE AMENDMENTS
- 2018 INTERNATIONAL MECHANICAL CODE (IMC) & WASHINGTON STATE AMENDMENTS
- 2018 UNIFORM PLUMBING CODE (UPC) & WASHINGTON STATE AMENDMENTS

VIBRATION AND ACOUSTICAL ISOLATION

THE FOLLOWING MEASURES SHALL BE TAKEN TO MINIMIZE VIBRATION AND NOISE TRANSMISSION FROM MECHANICAL AND ELECTRICAL EQUIPMENT TO THE INTERIOR SPACES:

TRANSFORMERS:

- A) PROVIDE FLEXIBLE CONDUIT OR MC CABLE AT EQUIPMENT CONNECTION.
- B) MOUNT TRANSFORMERS ON NEOPRENE GROMMET ISOLATORS.

SUBDUCT EXHAUST FANS:

- A) PROVIDE FLEXIBLE CONDUIT OR MC CABLE AT EQUIPMENT CONNECTION.

ENCLOSED GARAGE EXHAUST FANS:

- A) PROVIDE FLEXIBLE CONDUIT OR MC CABLE AT EQUIPMENT CONNECTION.

ROOFTOP AIR HANDLERS:

- A) PROVIDE FLEXIBLE CONDUIT OR MC CABLE AT EQUIPMENT CONNECTION.

FAN COIL UNITS:

- A) PROVIDE FLEXIBLE CONDUIT OR MC CABLE AT EQUIPMENT CONNECTION.

ROOF MOUNTED CONDENSERS:

- A) PROVIDE FLEXIBLE CONDUIT OR MC CABLE AT EQUIPMENT CONNECTION.

FLEXIBLE CONDUIT OR MC CABLE CONNECTIONS FOR VIBRATION ISOLATION SHALL BE A MINIMUM OF TWO FEET LONG.



TEMPERATURE LIMITATION OF CONDUCTORS

ADDITIONAL ADJUSTMENTS FOR CONDUITS EXPOSED TO SUNLIGHT ON OR ABOVE ROOFTOPS SHALL BE FACTORED PER NEC TABLE 310.15(B)(2)(C)

CONDUIT & CONDUCTOR FIRE RATING

1. CONDUIT FOR ELECTRICAL CONDUCTORS BY THE FACP OR FIRE ALARM SYSTEM SHALL BE IN 2 HOUR RATED ENCLOSURES OR ENCASED IN 2-INCH OF CONCRETE AND RATED CABLE ASSEMBLIES, OR BE CONDUCTORS IN 2 HOUR-RATED RACEWAYS PER NFPA 72.
2. THE EQUIPMENT AND CONTROL WIRING SHALL BE ENCLOSED BY FIRE BARRIERS CONSTRUCTED IN ACCORDANCE WITH IBC SECTION 707 OR HORIZONTAL ASSEMBLIES CONSTRUCTED IN ACCORDANCE WITH IBC SECTION 711, OR USING A 2 HR RATED CABLE SYSTEM OR ENCLOSED WITHIN 2" OF CONCRETE.
3. FIRE ALARM WIRING SHALL COMPLY WITH IBC 907.6.1. WIRING SHALL COMPLY WITH THE REQUIREMENTS OF NFPA 70.
4. RACEWAYS FOR THE DEDICATED BRANCH CIRCUIT(S) REQUIRED FOR PRIMARY POWER TO THE FIRE ALARM CONTROL PANEL (FACP) SHALL BE IN 2 HOUR RATED ENCLOSURES OR ENCASED IN 2-INCH OF CONCRETE AND RATED CABLE ASSEMBLIES, OR BE CONDUCTORS IN 2 HOUR-RATED RACEWAYS PER IBC 907 AND NFPA 72 SECTION 10.6.11.3.1.3

NO.	DATE	DESCRIPTION	REVISIONS

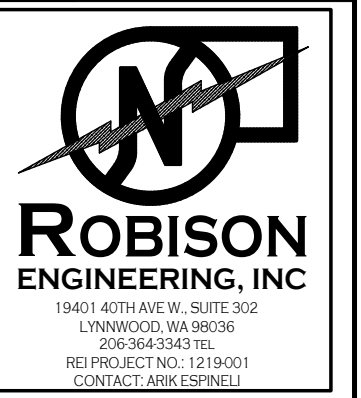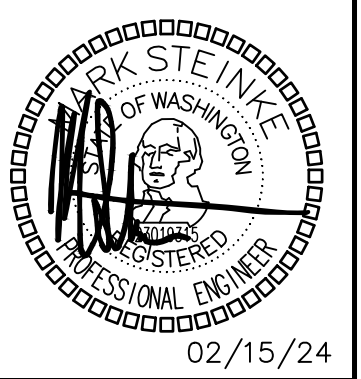


DRAWN: KL	DESIGNED: MHS	CHECKED: PSR	APPROVED: JAY
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHTS APARTMENTS BUILDING A
 27TH AVE SE AND 5TH ST SE PUYALLUP, WA
 19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343
ROBISON ENGINEERING, INC

DATE: 02/15/24

SHEET TITLE:
LEGEND, GENERAL NOTES, DRAWING INDEX

SHEET NO.
E0.01

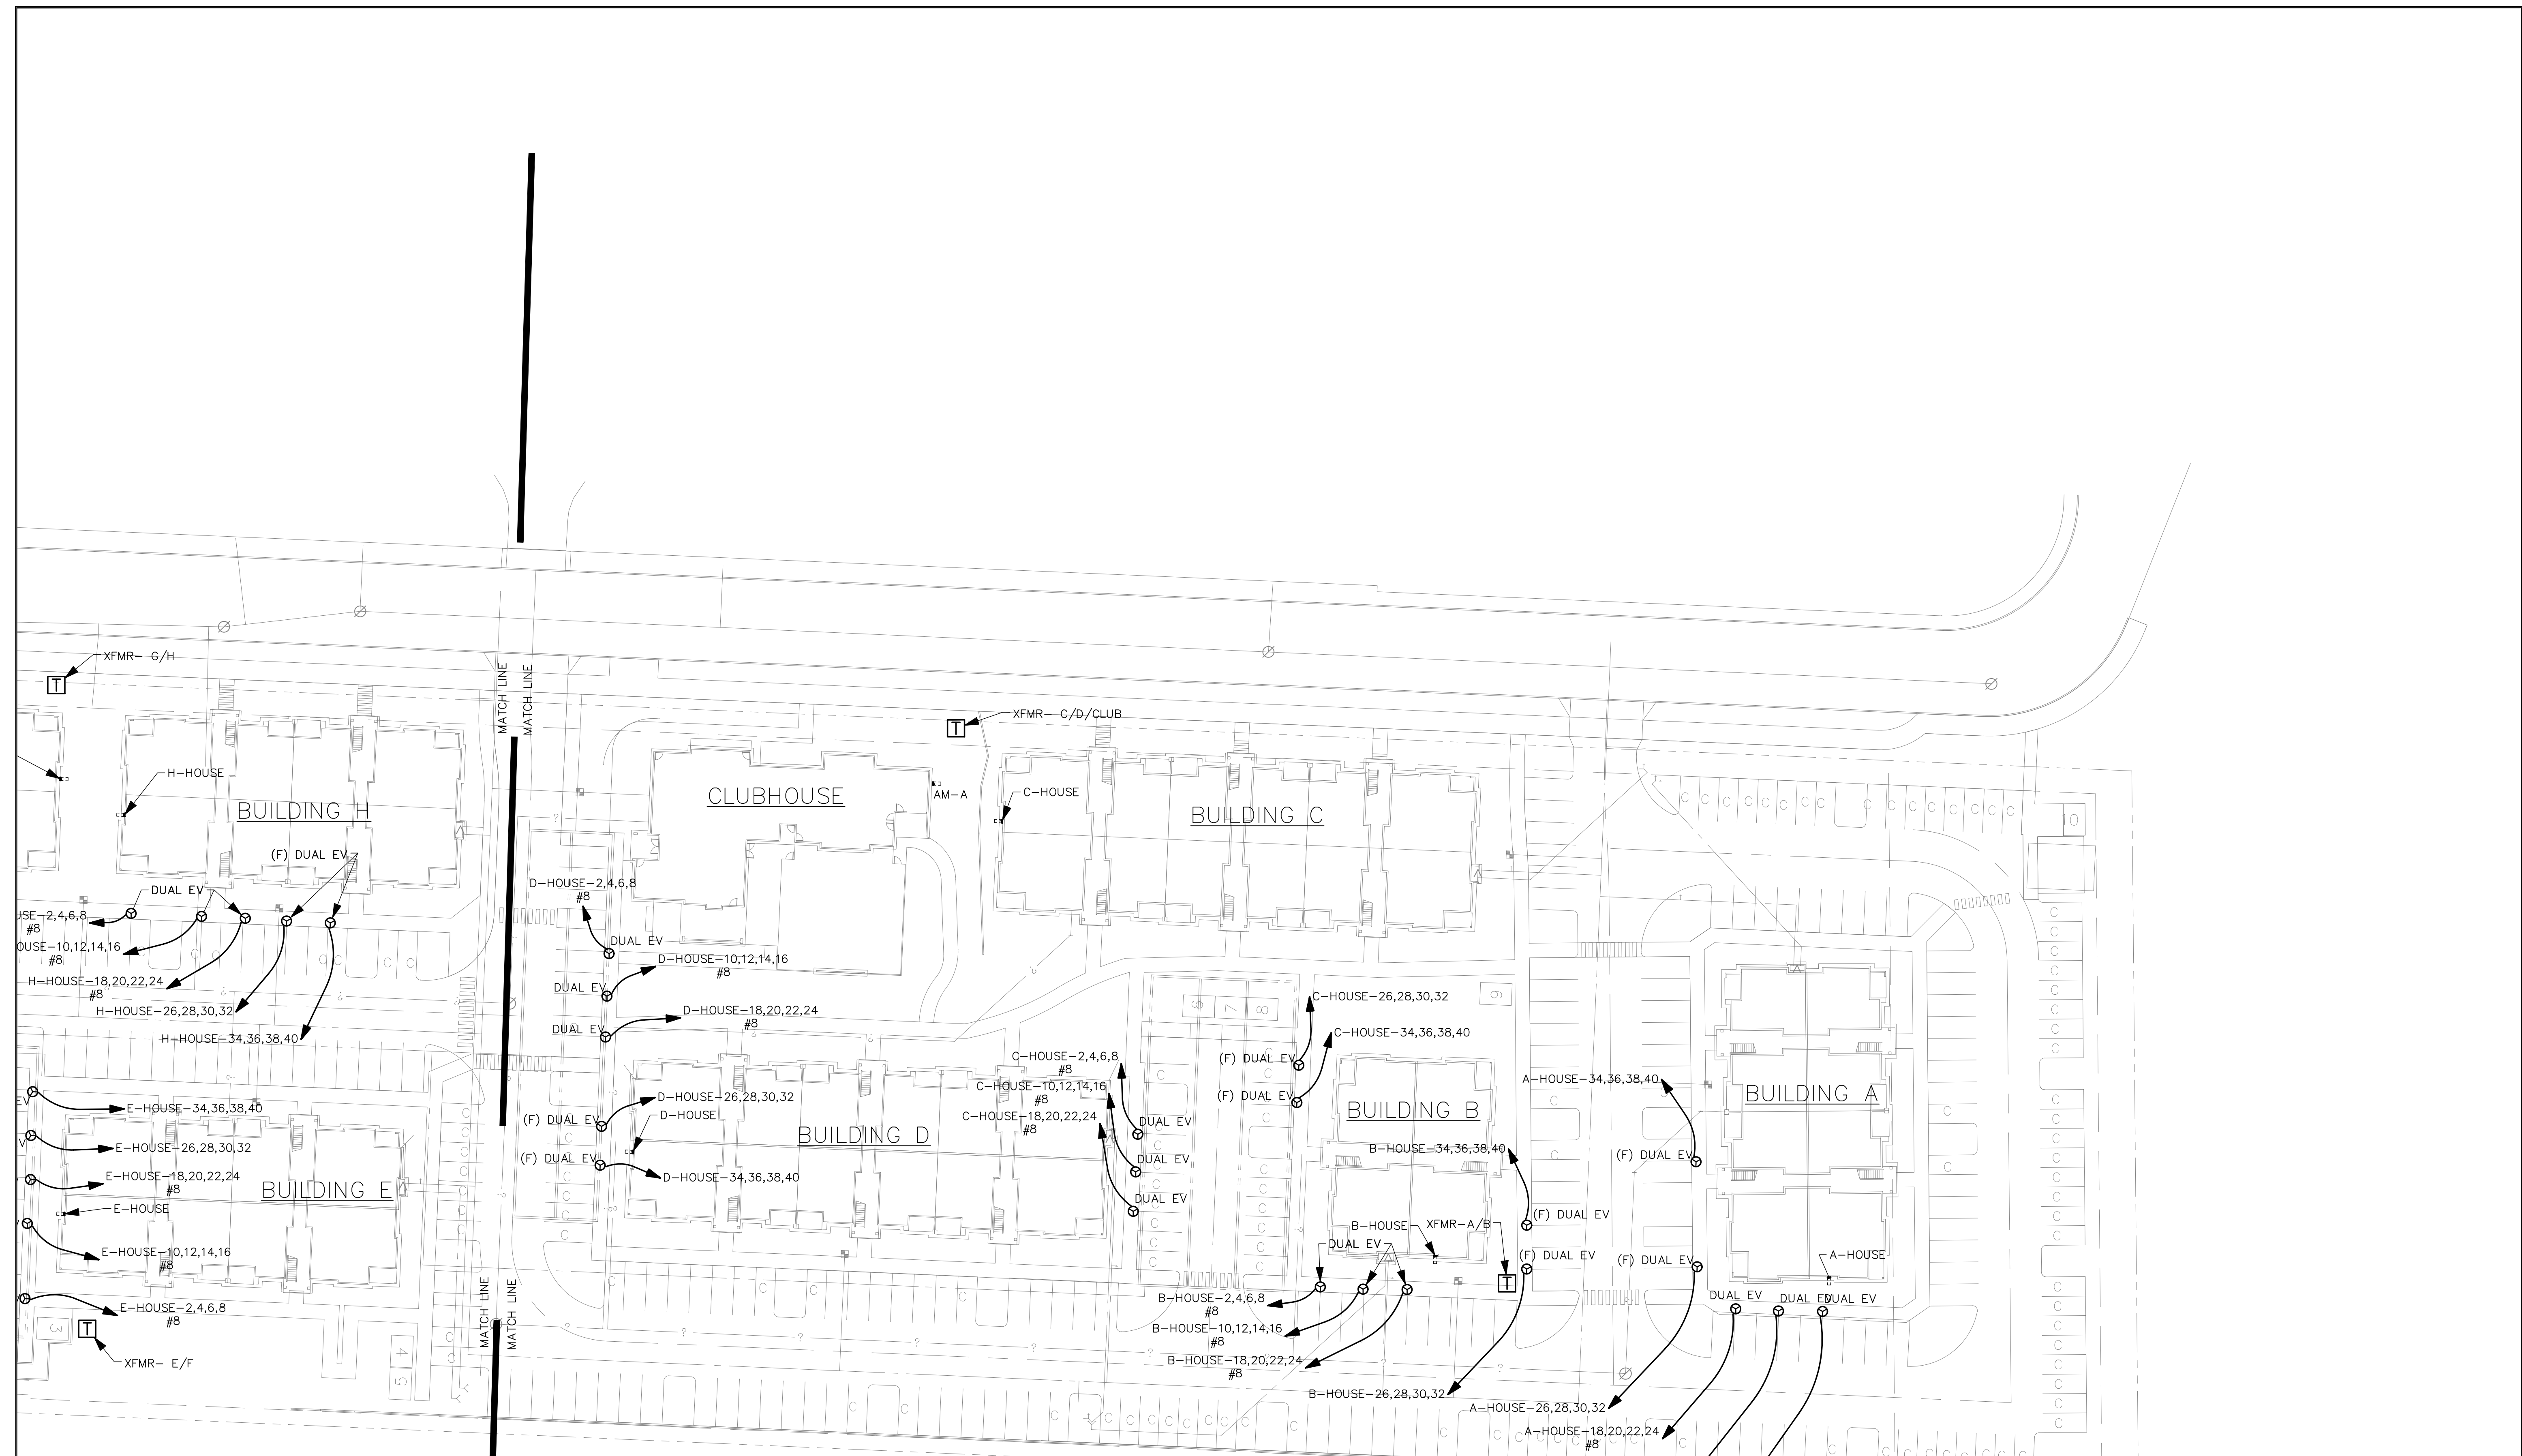


SHEET NOTES:

1. EV CHARGER LOCATIONS:
 - 1.1. PROVIDE PRE-FABRICATED EV CHARGING STATION.
 - 1.2. FOUNDATION TO INCLUDE ACCESSIBLE UNDERGROUND PULLBOX, CONDUIT ENTRY PORTS AND COVERPLATE DESIGNED FOR DIRECT-MOUNTING EV CHARGER PEDESTAL.
 - 1.3. PROVIDE FOUNDATION PRODUCTS BY BREEZE-EV, EV-BLOCKS OR EQUIVALENT.
 - 1.4. IF FOUNDATION IS INSTALLED LESS THAN 2'-0" FROM THE EDGE OF THE CURB, THEN PROVIDE A BOLLARD AT EACH CORNER OF THE FOUNDATION THAT COMPLIES WITH 2018 IBC 1607.9
2. (F) DUAL EV CHARGING STATIONS: PROVIDE 1-1/4" CONDUIT WITH PULL WIRE FROM EV PANEL(S) IN ELECTRICAL ROOM AS INDICATED.
3. DUAL EV CHARGING STATIONS: PROVIDE AND INSTALL 1-1/4" CONDUIT, CONDUCTORS, AND REQUIRED BREAKERS FOR DUAL EV CHARGING STATIONS.

SITE POWER PLAN - EAST

SCALE: 1/32" = 1'-0"

NO.	DATE	DESCRIPTION	REVISIONS

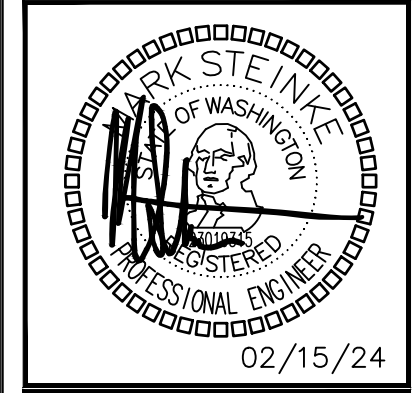

DRAWN: KL	DESIGNED: MHS	CHECKED: PSR	APPROVED: JAY
-----------	---------------	--------------	---------------


PROJECT: BRADLEY HEIGHTS APARTMENTS BUILDING A
 27TH AVE SE AND 5TH ST SE PUYALLUP, WA

DATE: 02/15/24


SHEET TITLE:
SITE POWER - EAST SITE PLAN

SHEET NO.
E0.10

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343
ROBISON ENGINEERING, INC.

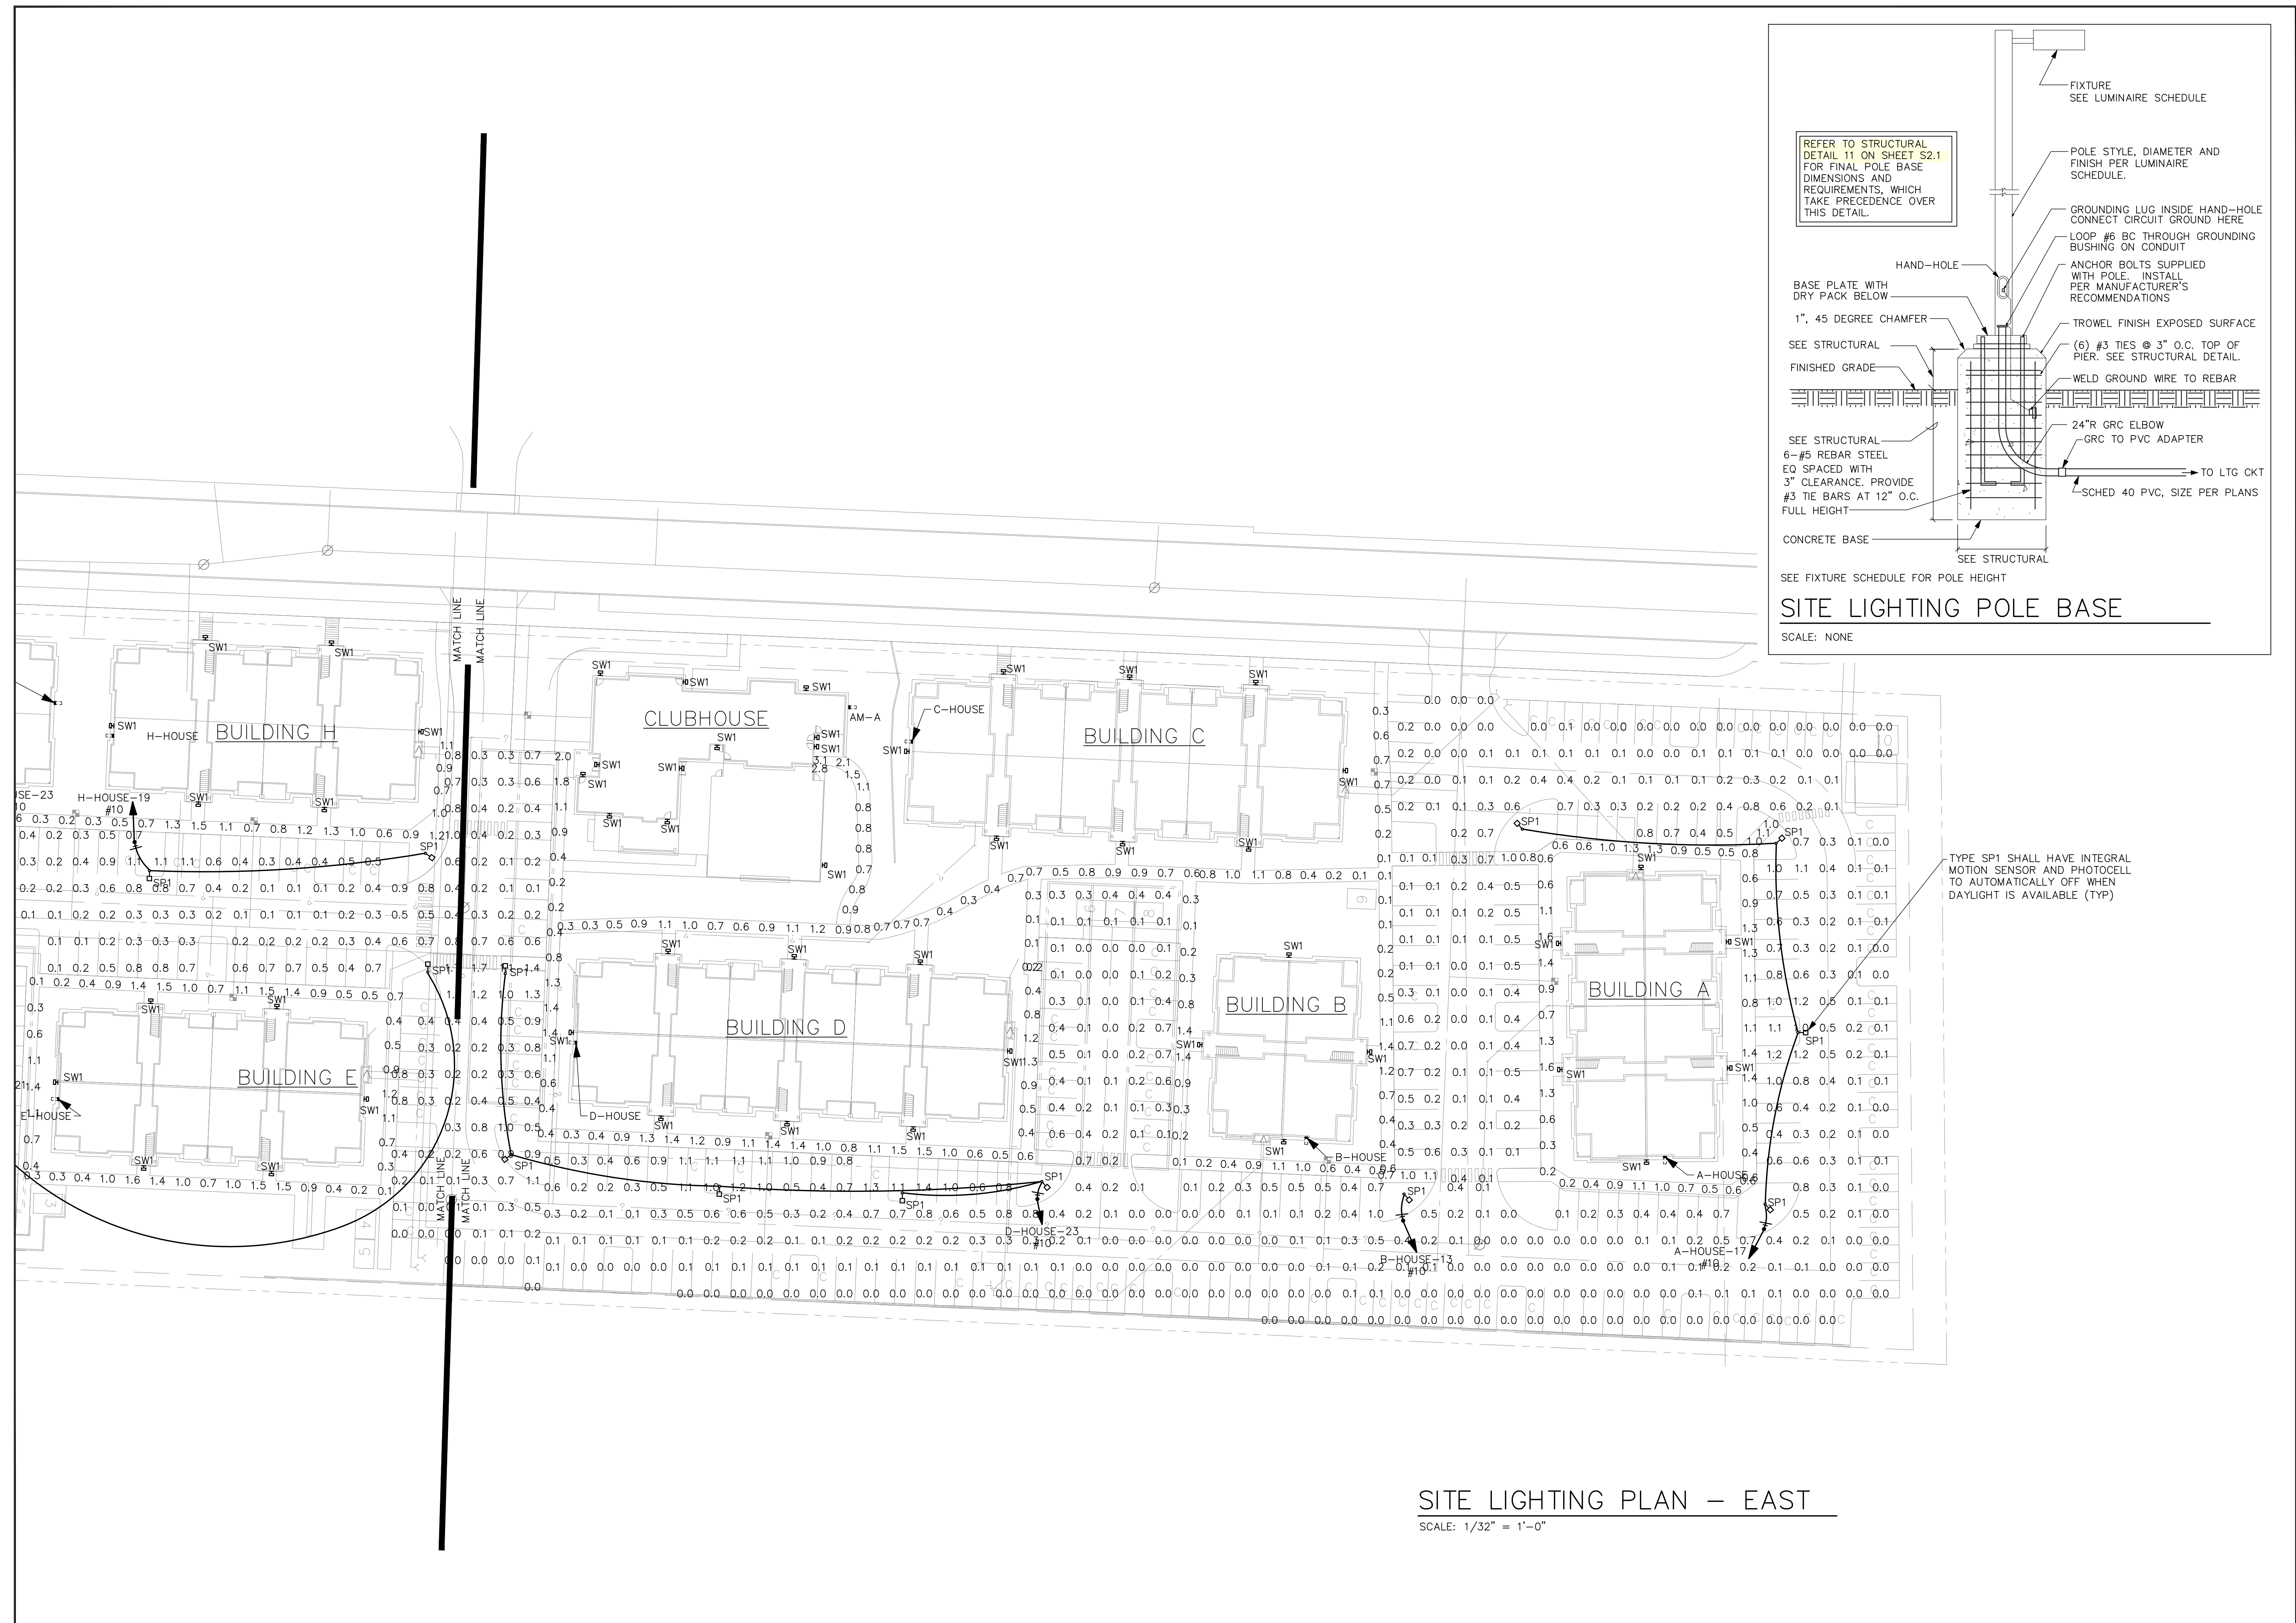

NO.	DATE	DESCRIPTION	REVISIONS

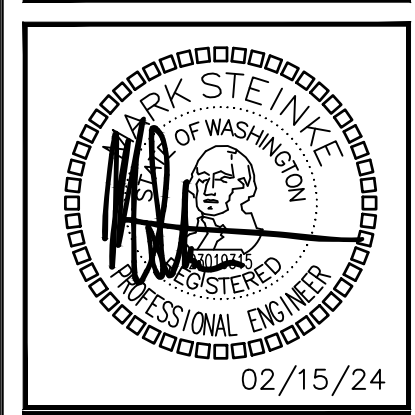

DRAWN: KL	DESIGNED: MHS	CHECKED: PSR	APPROVED: JAY
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHTS APARTMENTS BUILDING A
27TH AVE SE AND 5TH ST SE PUYALLUP, WA


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 364-3343

ROBISON ENGINEERING, INC

DATE: 02/15/24

SHEET TITLE:
SITE LIGHTING - EAST SITE PLAN

SHEET NO.
E0.11

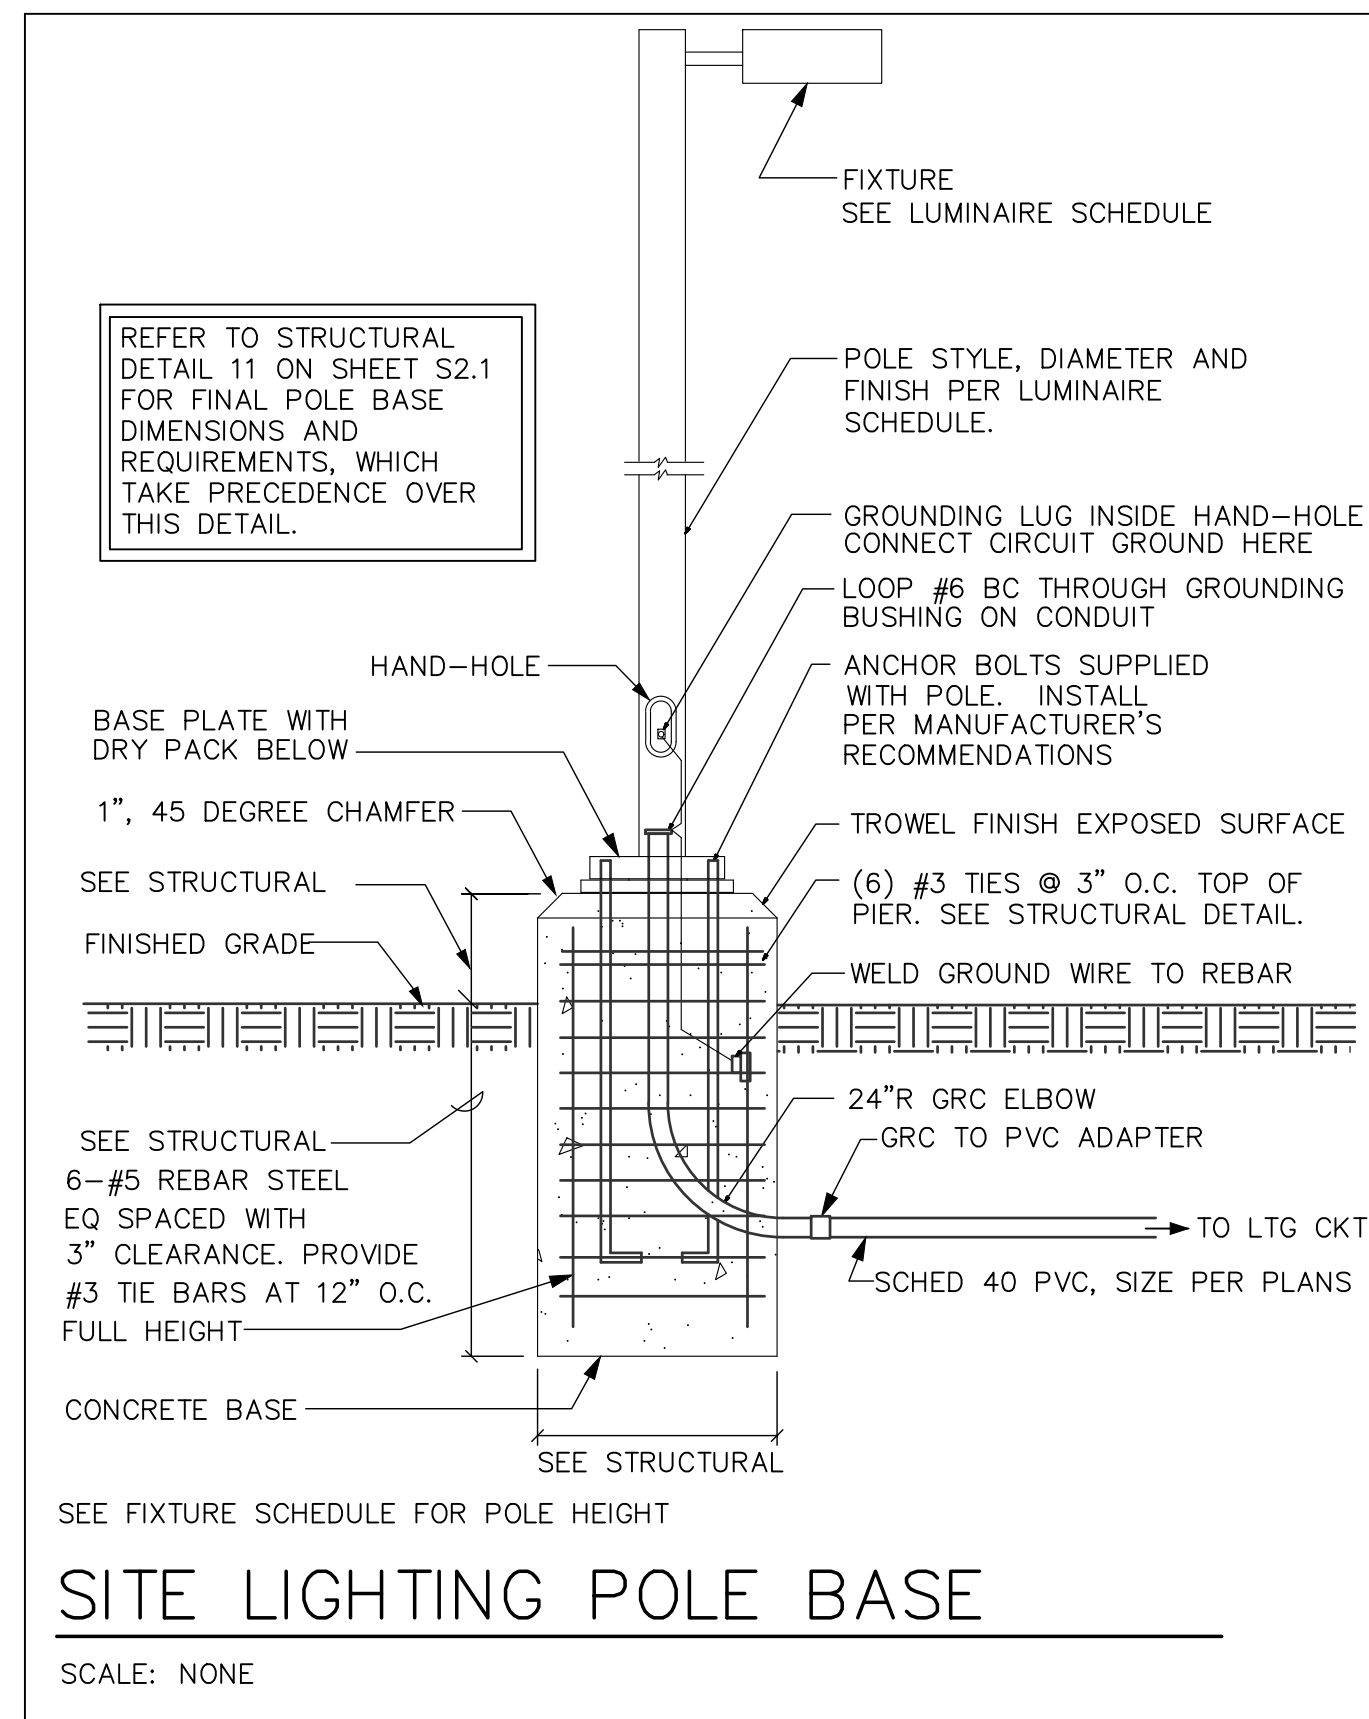


Drive Aisle Photometric Schedule

AVERAGE FOOT-CANDLES	0.31
MAXIMUM FOOT-CANDLES	1.7
MINIMUM FOOT-CANDLES	0.0
MAXIMUM TO MINIMUM FC RATIO	320.63
AVERAGE TO MINIMUM FC RATIO	57.83

Walkway Photometric Schedule

AVERAGE FOOT-CANDLES	0.80
MAXIMUM FOOT-CANDLES	3.1
MINIMUM FOOT-CANDLES	0.1
MAXIMUM TO MINIMUM FC RATIO	41.55
AVERAGE TO MINIMUM FC RATIO	10.73

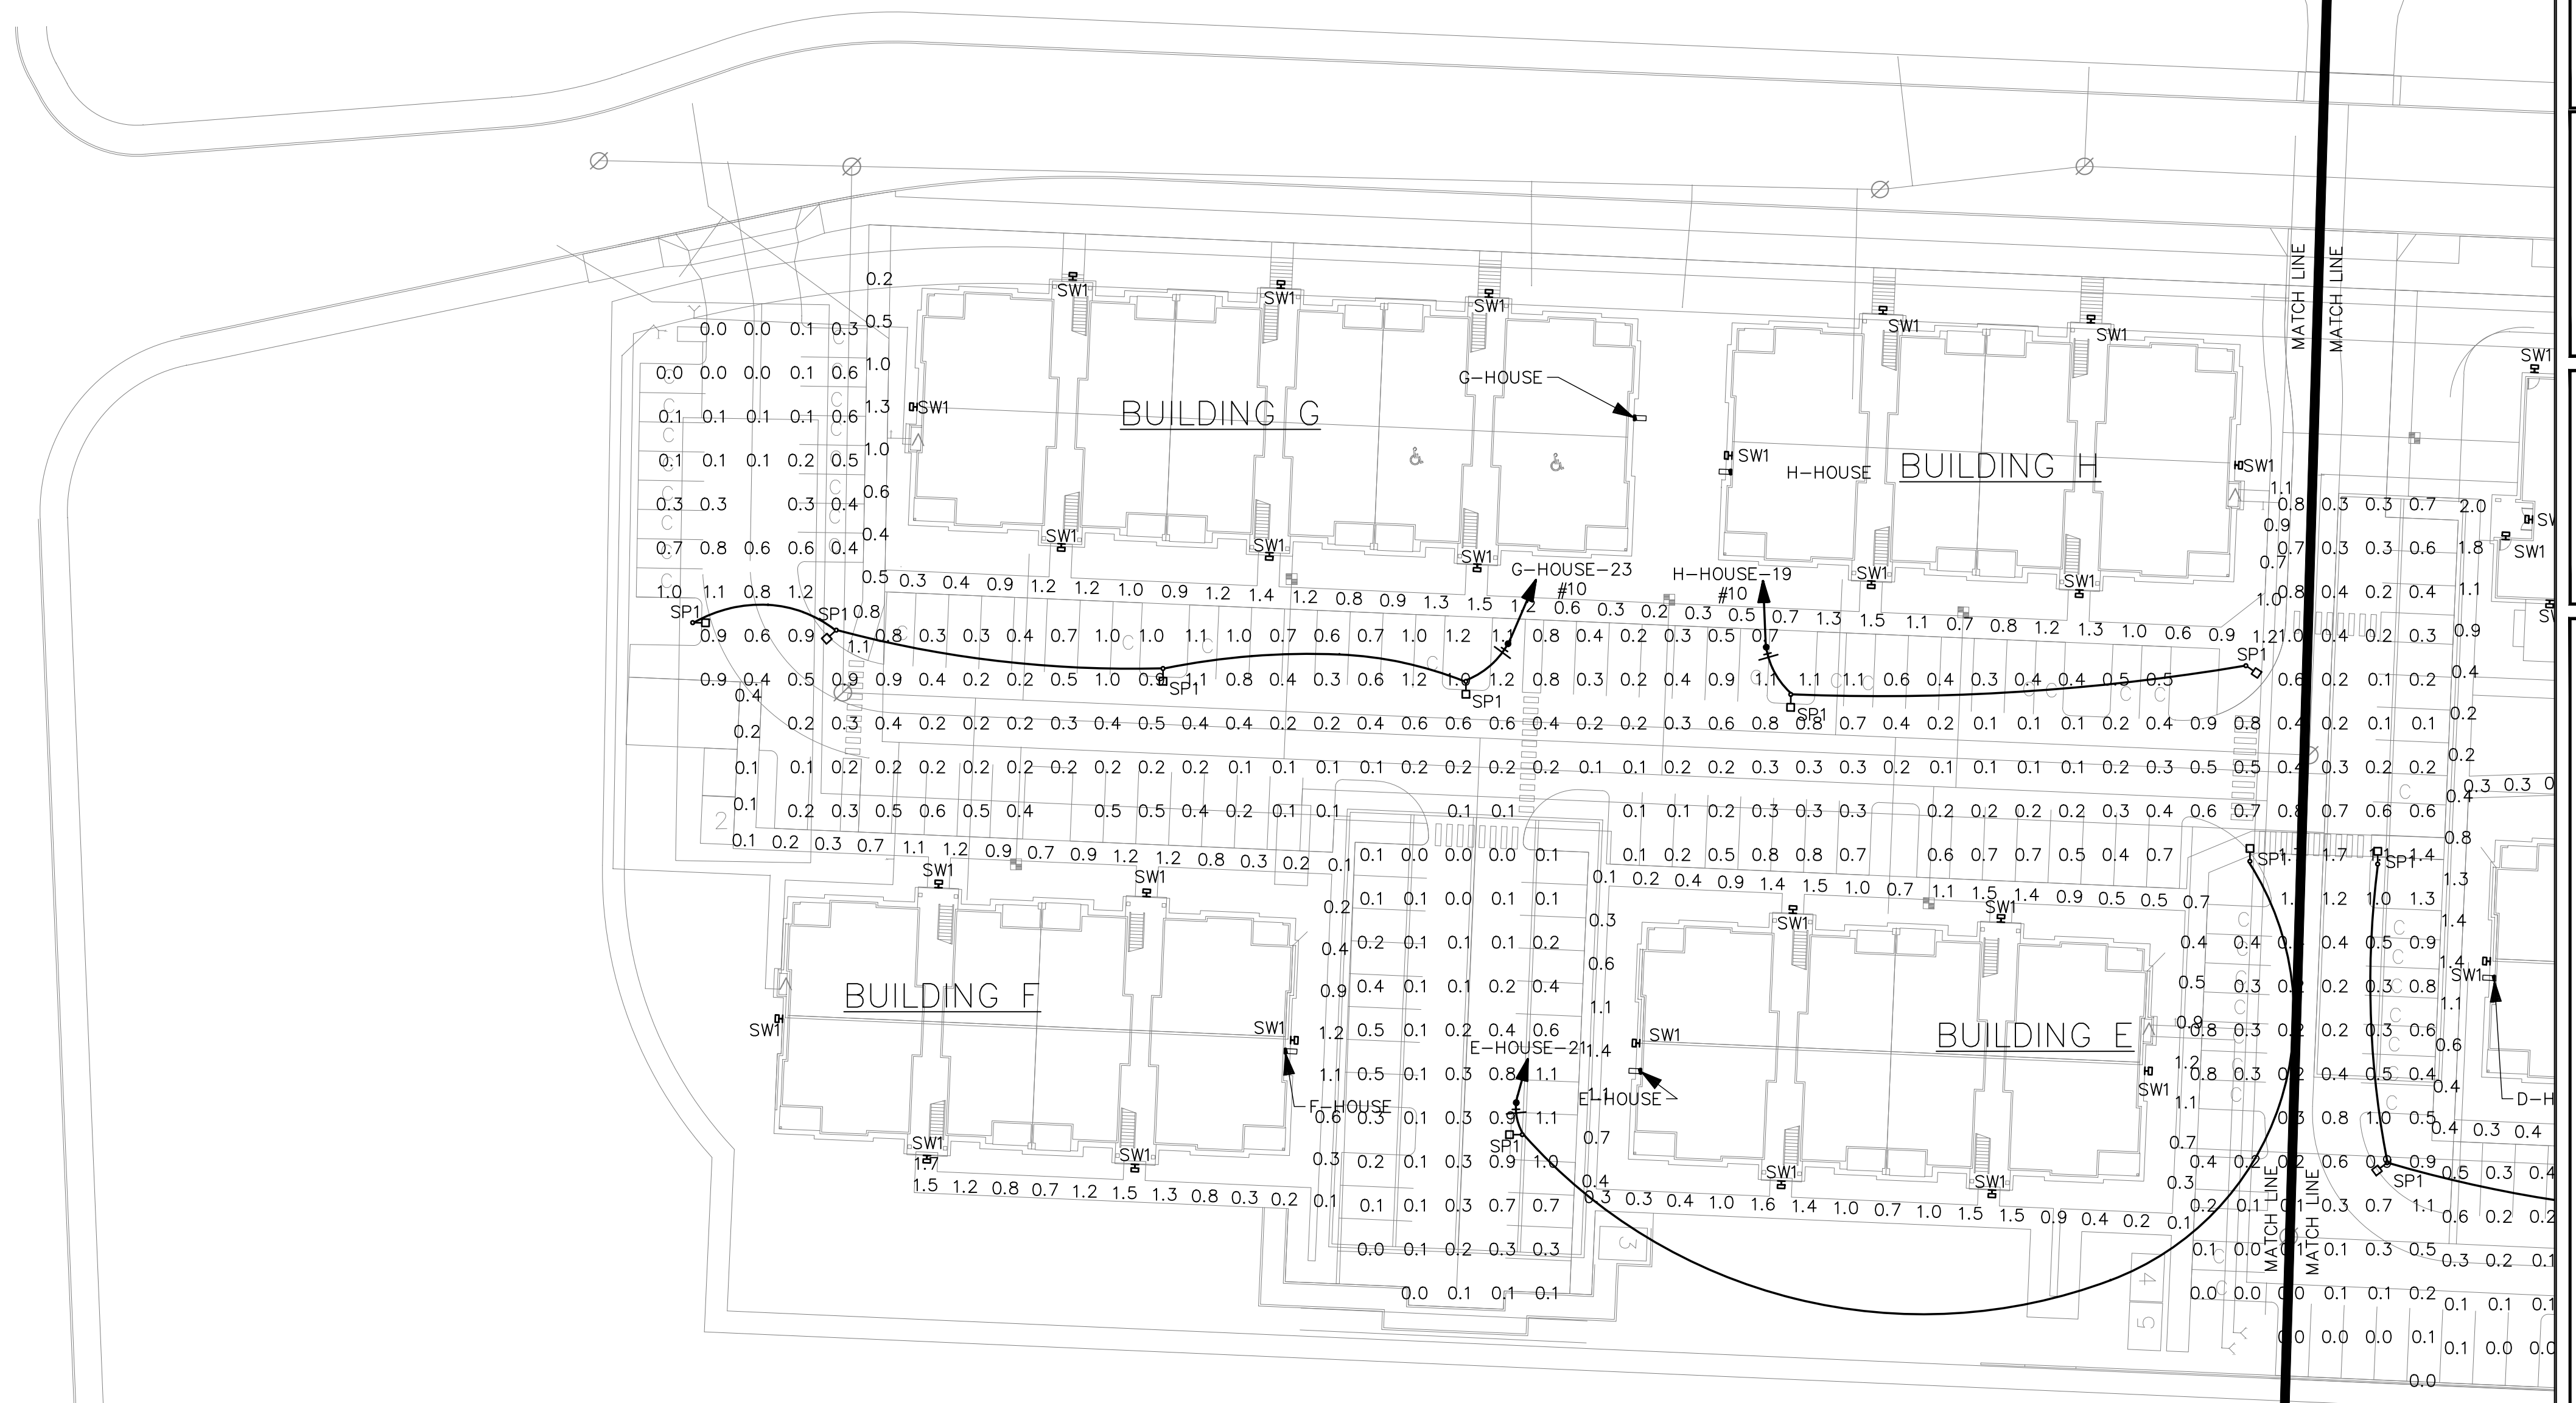

SITE LIGHTING PLAN – WEST

SCALE: 1/32" = 1'-0"

NO.	DATE	DESCRIPTION

02/15/24

ROBISON ENGINEERING, INC.

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 364-3343
FAX: (206) 364-3343

DRAWN: KL
DESIGNED: MHS
CHECKED: PSR
APPROVED: JAY

PROJECT: BRADLEY HEIGHTS APARTMENTS BUILDING A
27TH AVE SE AND 5TH ST SE PUYALLUP, WA

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 364-3343

ROBISON ENGINEERING, INC.

DATE: 02/15/24

SHEET TITLE:
SITE LIGHTING - EAST SITE PLAN

SHEET NO.
E0.12


COPYRIGHT 2023, ROBISON ENGINEERING, INC.
MSTEINKAMP\RESOURCE FOLDER\STEINKAMP LEAVENS TEMPLATES\APARTMENT 30042\E1.00 LIGHTING.LDW 09-26-2022 11:30

GENERAL NOTES


- EMERGENCY EGRESS LIGHTING: EMERGENCY LUMINAIRES WITH 90 MINUTE BATTERY BACKUP.
- REFER TO SERIES E500 DRAWINGS FOR TYPICAL UNIT PLANS SHOWING ELECTRICAL AND LIGHTING LAYOUT.
- SEE SHEET E1.50 FOR LUMINAIRE SCHEDULE AND LIGHTING NOTES.

FLAG NOTES

- CIRCUIT STAIRS VERTICALLY. LUMINAIRE(S) IN STAIRWELL
- EXIT SIGNS: PROVIDE UNSWITCHED HOT.

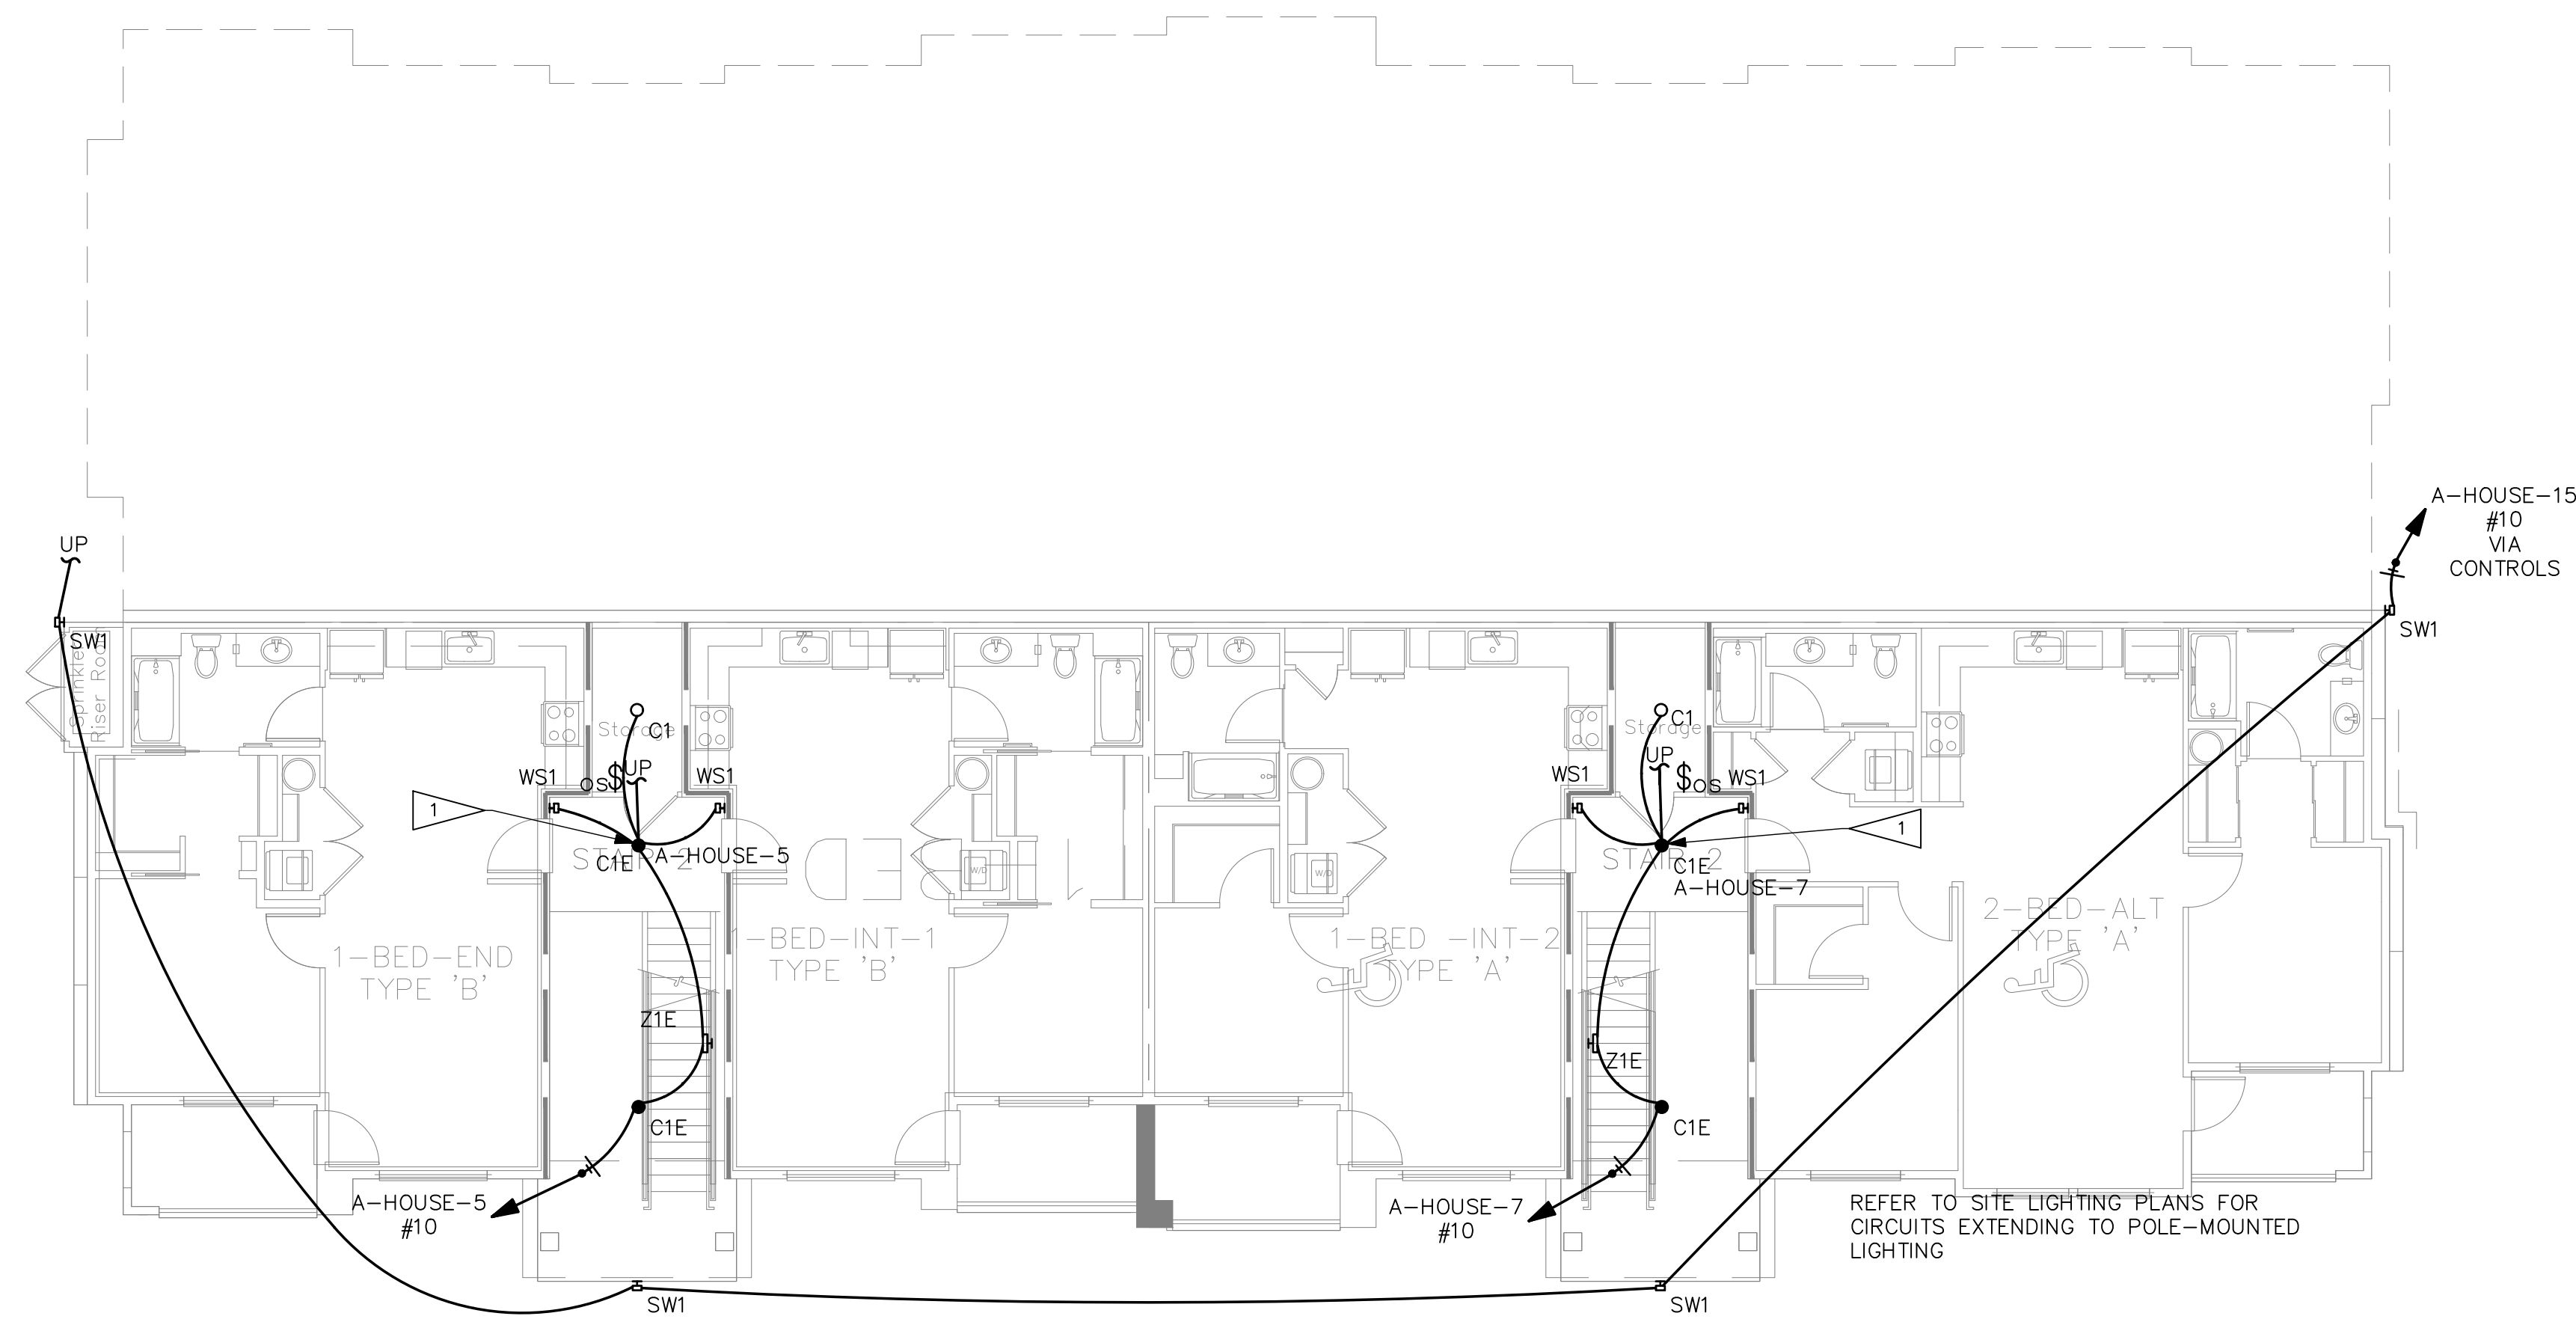

LIGHTING PLAN – BASEMENT
SCALE: 1/8" = 1'-0"

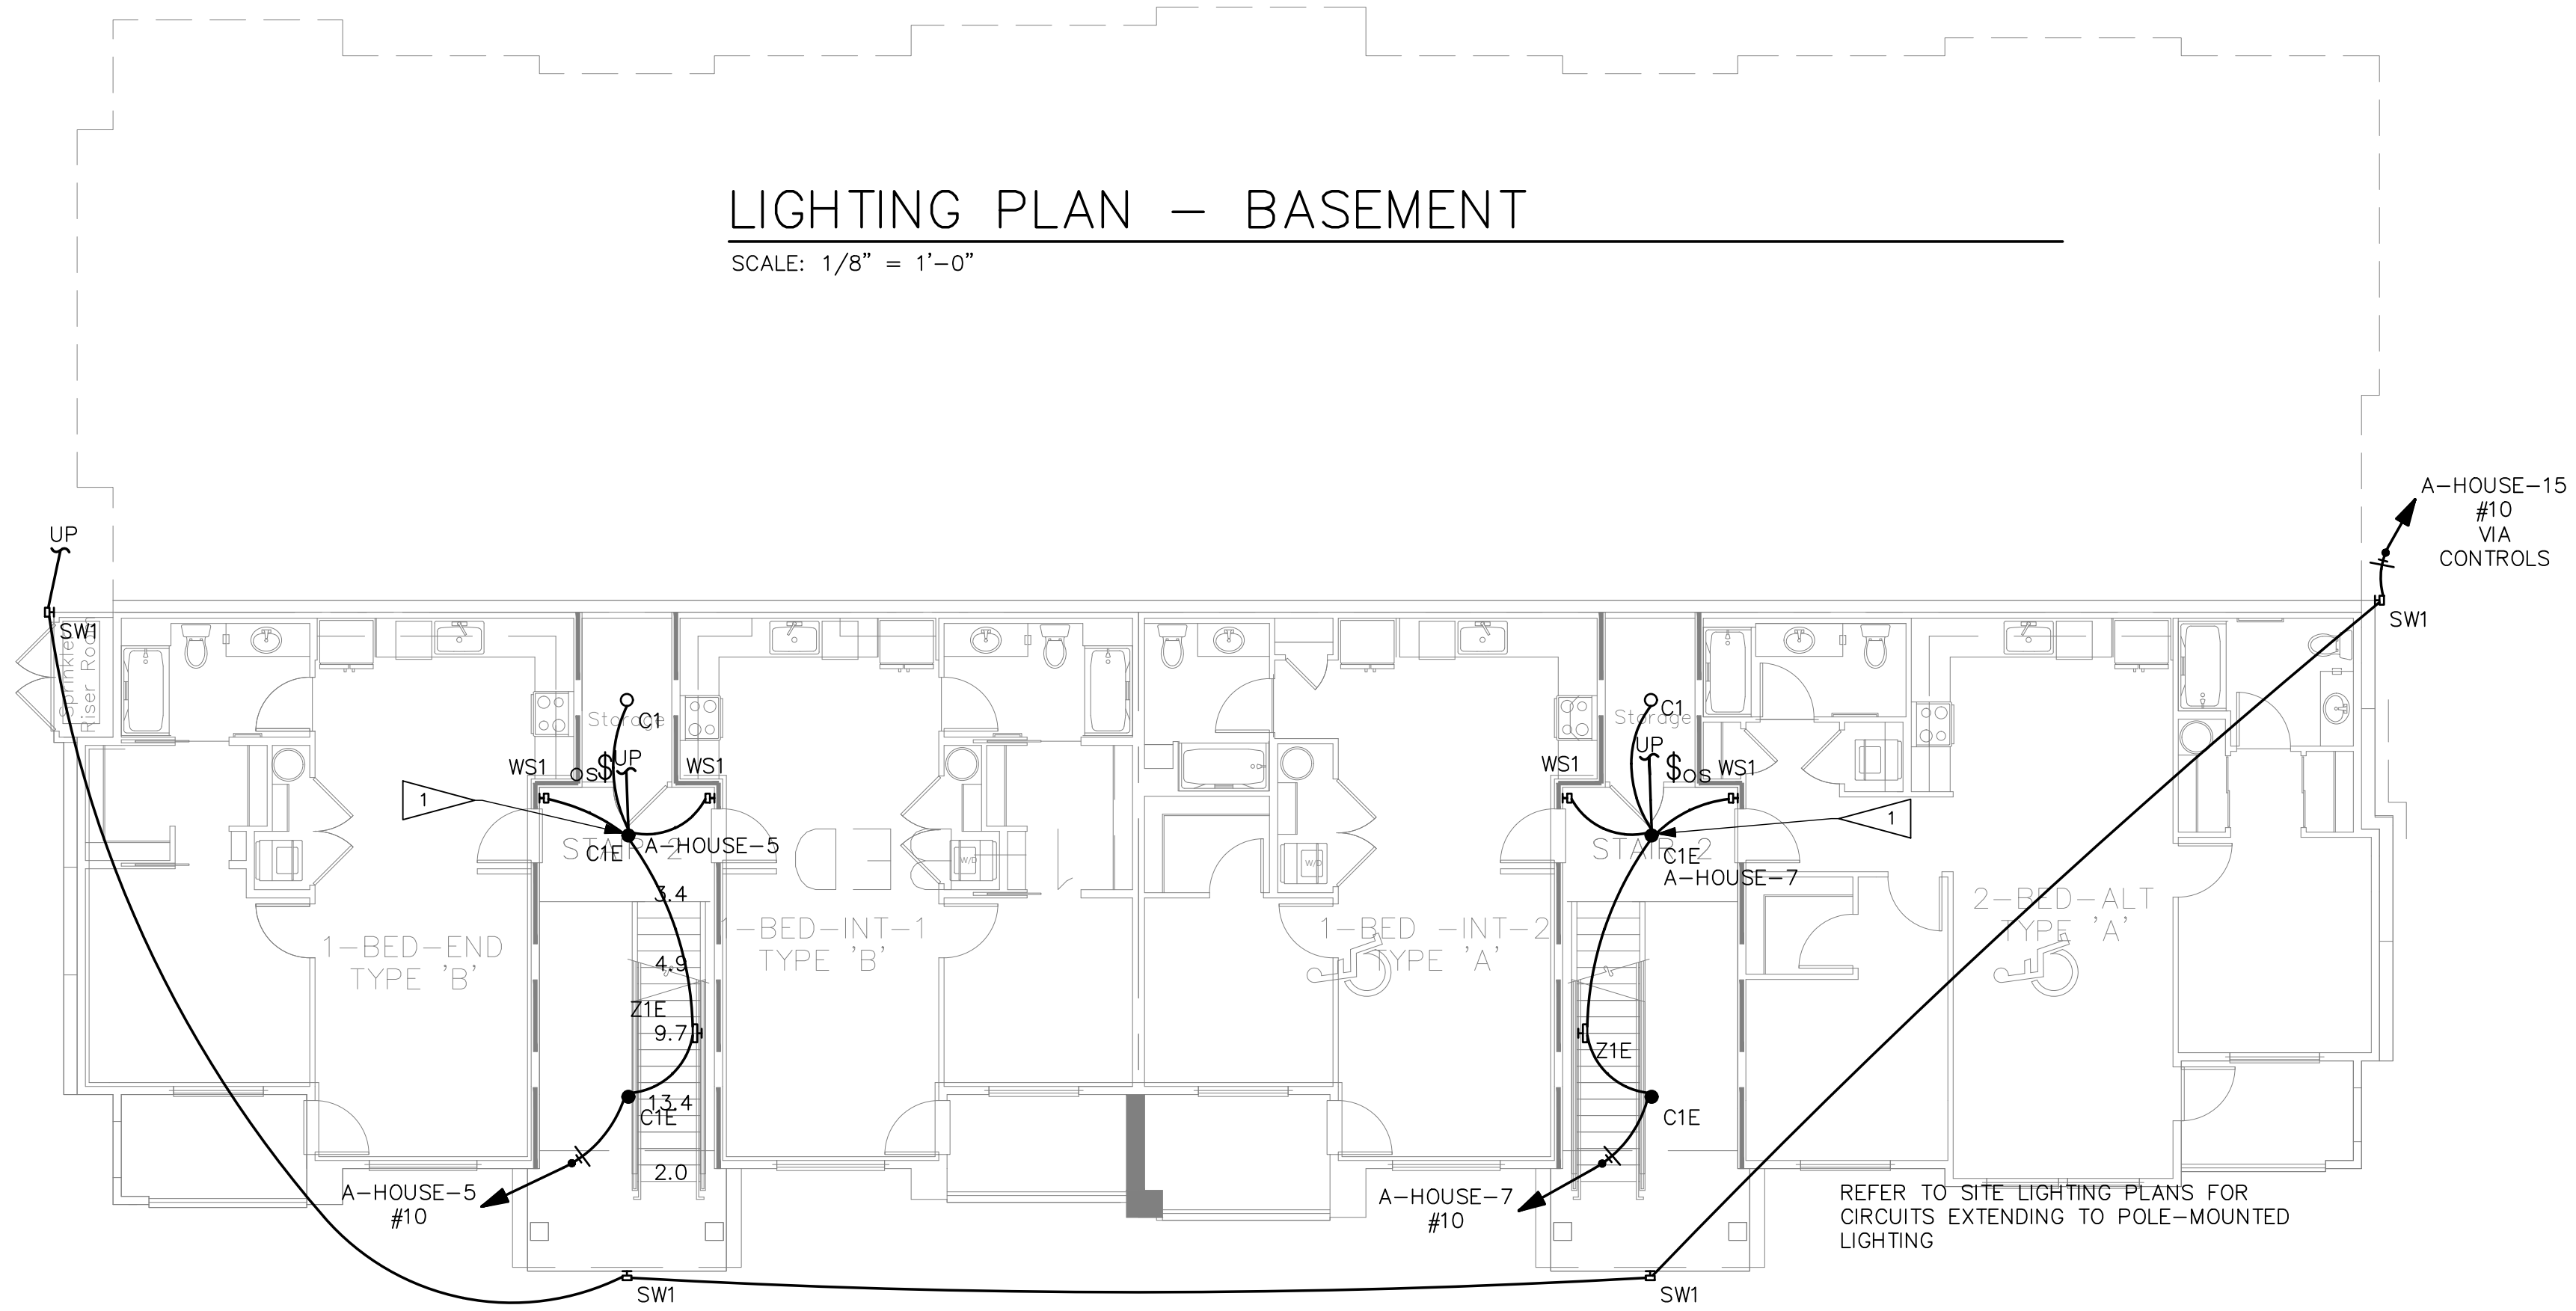


PHOTOMETRIC PLAN – BASEMENT
SCALE: 1/8" = 1'-0"

Egress Basement Stairs Photometric Schedule

AVERAGE FOOT-CANDLES	6.67
MAXIMUM FOOT-CANDLES	13.4
MINIMUM FOOT-CANDLES	2.0
MINIMUM TO MAXIMUM FC RATIO	0.15
MAXIMUM TO MINIMUM FC RATIO	6.68
AVERAGE TO MINIMUM FC RATIO	3.34

NO.	DATE	DESCRIPTION	REVISIONS

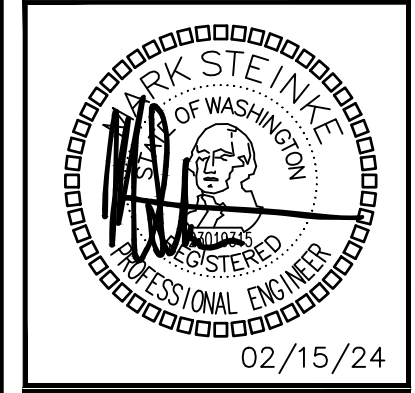

DRAWN:	KL
DESIGNED:	MHS
CHECKED:	PSR
APPROVED:	JAY

PROJECT: BRADLEY HEIGHTS APARTMENTS
27TH AVE SE AND 5TH ST BELLEVUE, WA


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 364-3343

ROBISON ENGINEERING, INC

DATE: 02/15/24



SHEET TITLE:
LIGHTING & PHOTOMETRIC PLAN - BASEMENT

SHEET NO.
E1.00

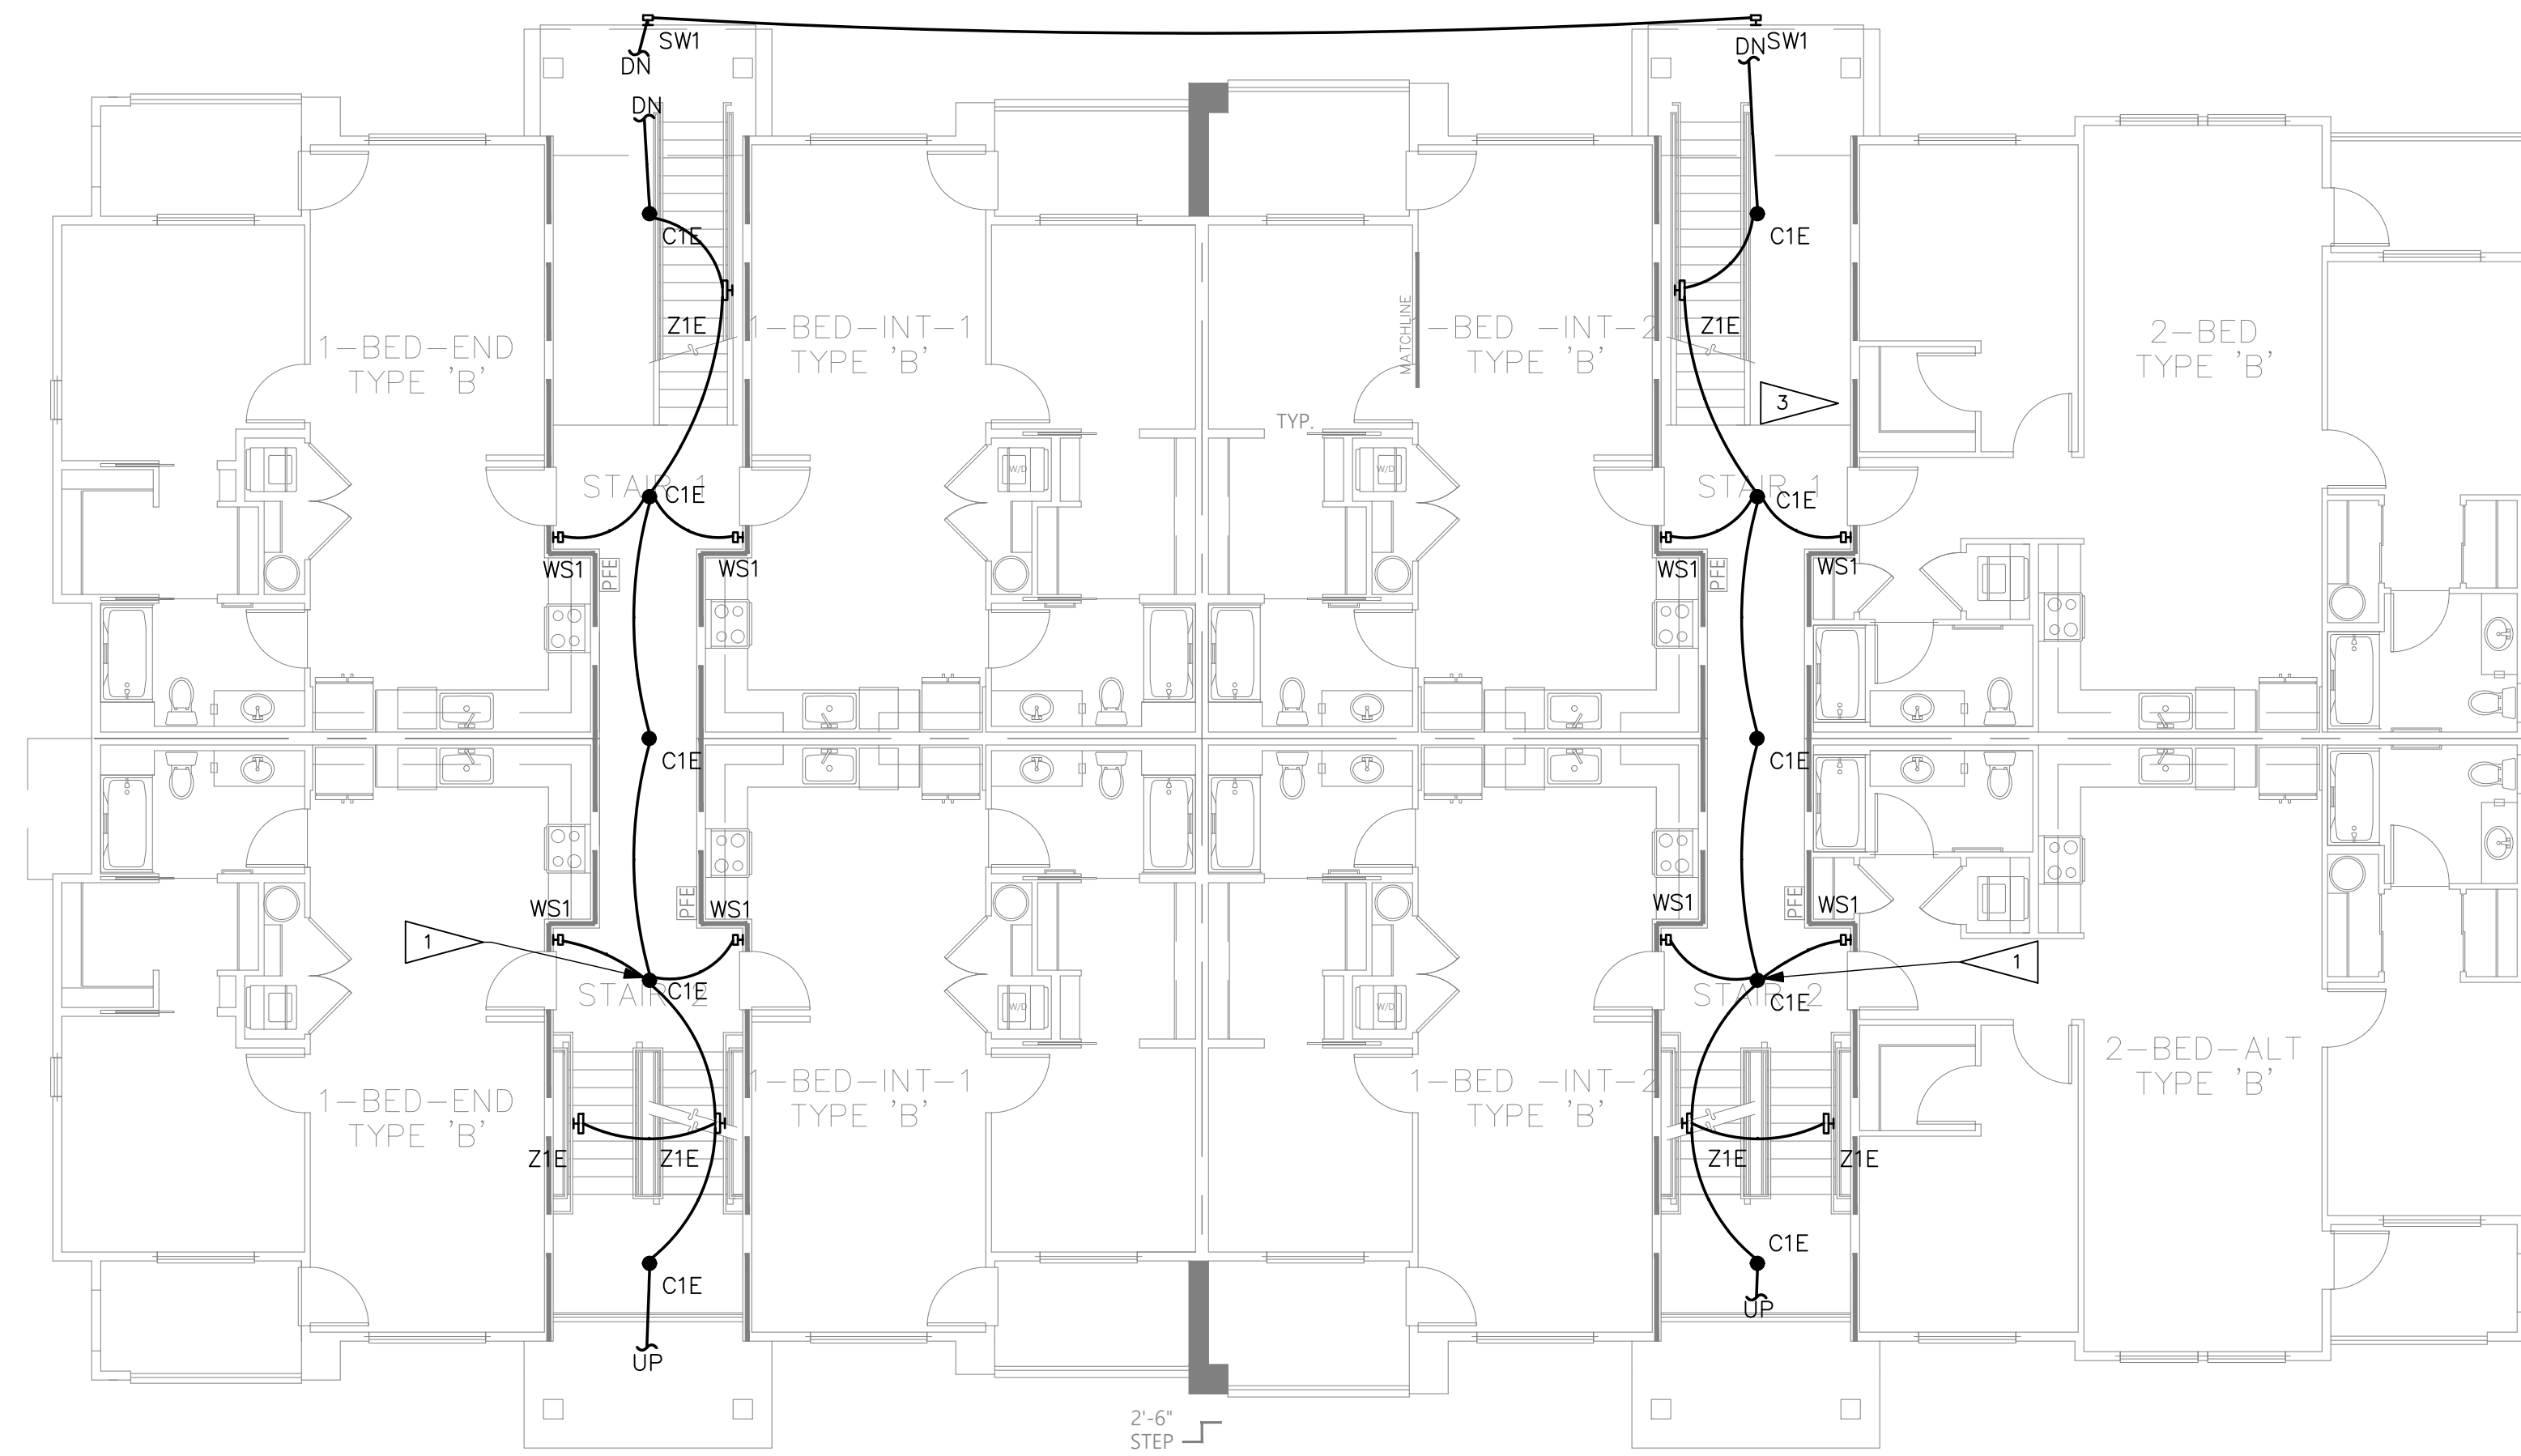


LIGHTING PLAN – 1ST FLOOR

SCALE: 1/8" = 1'-0"

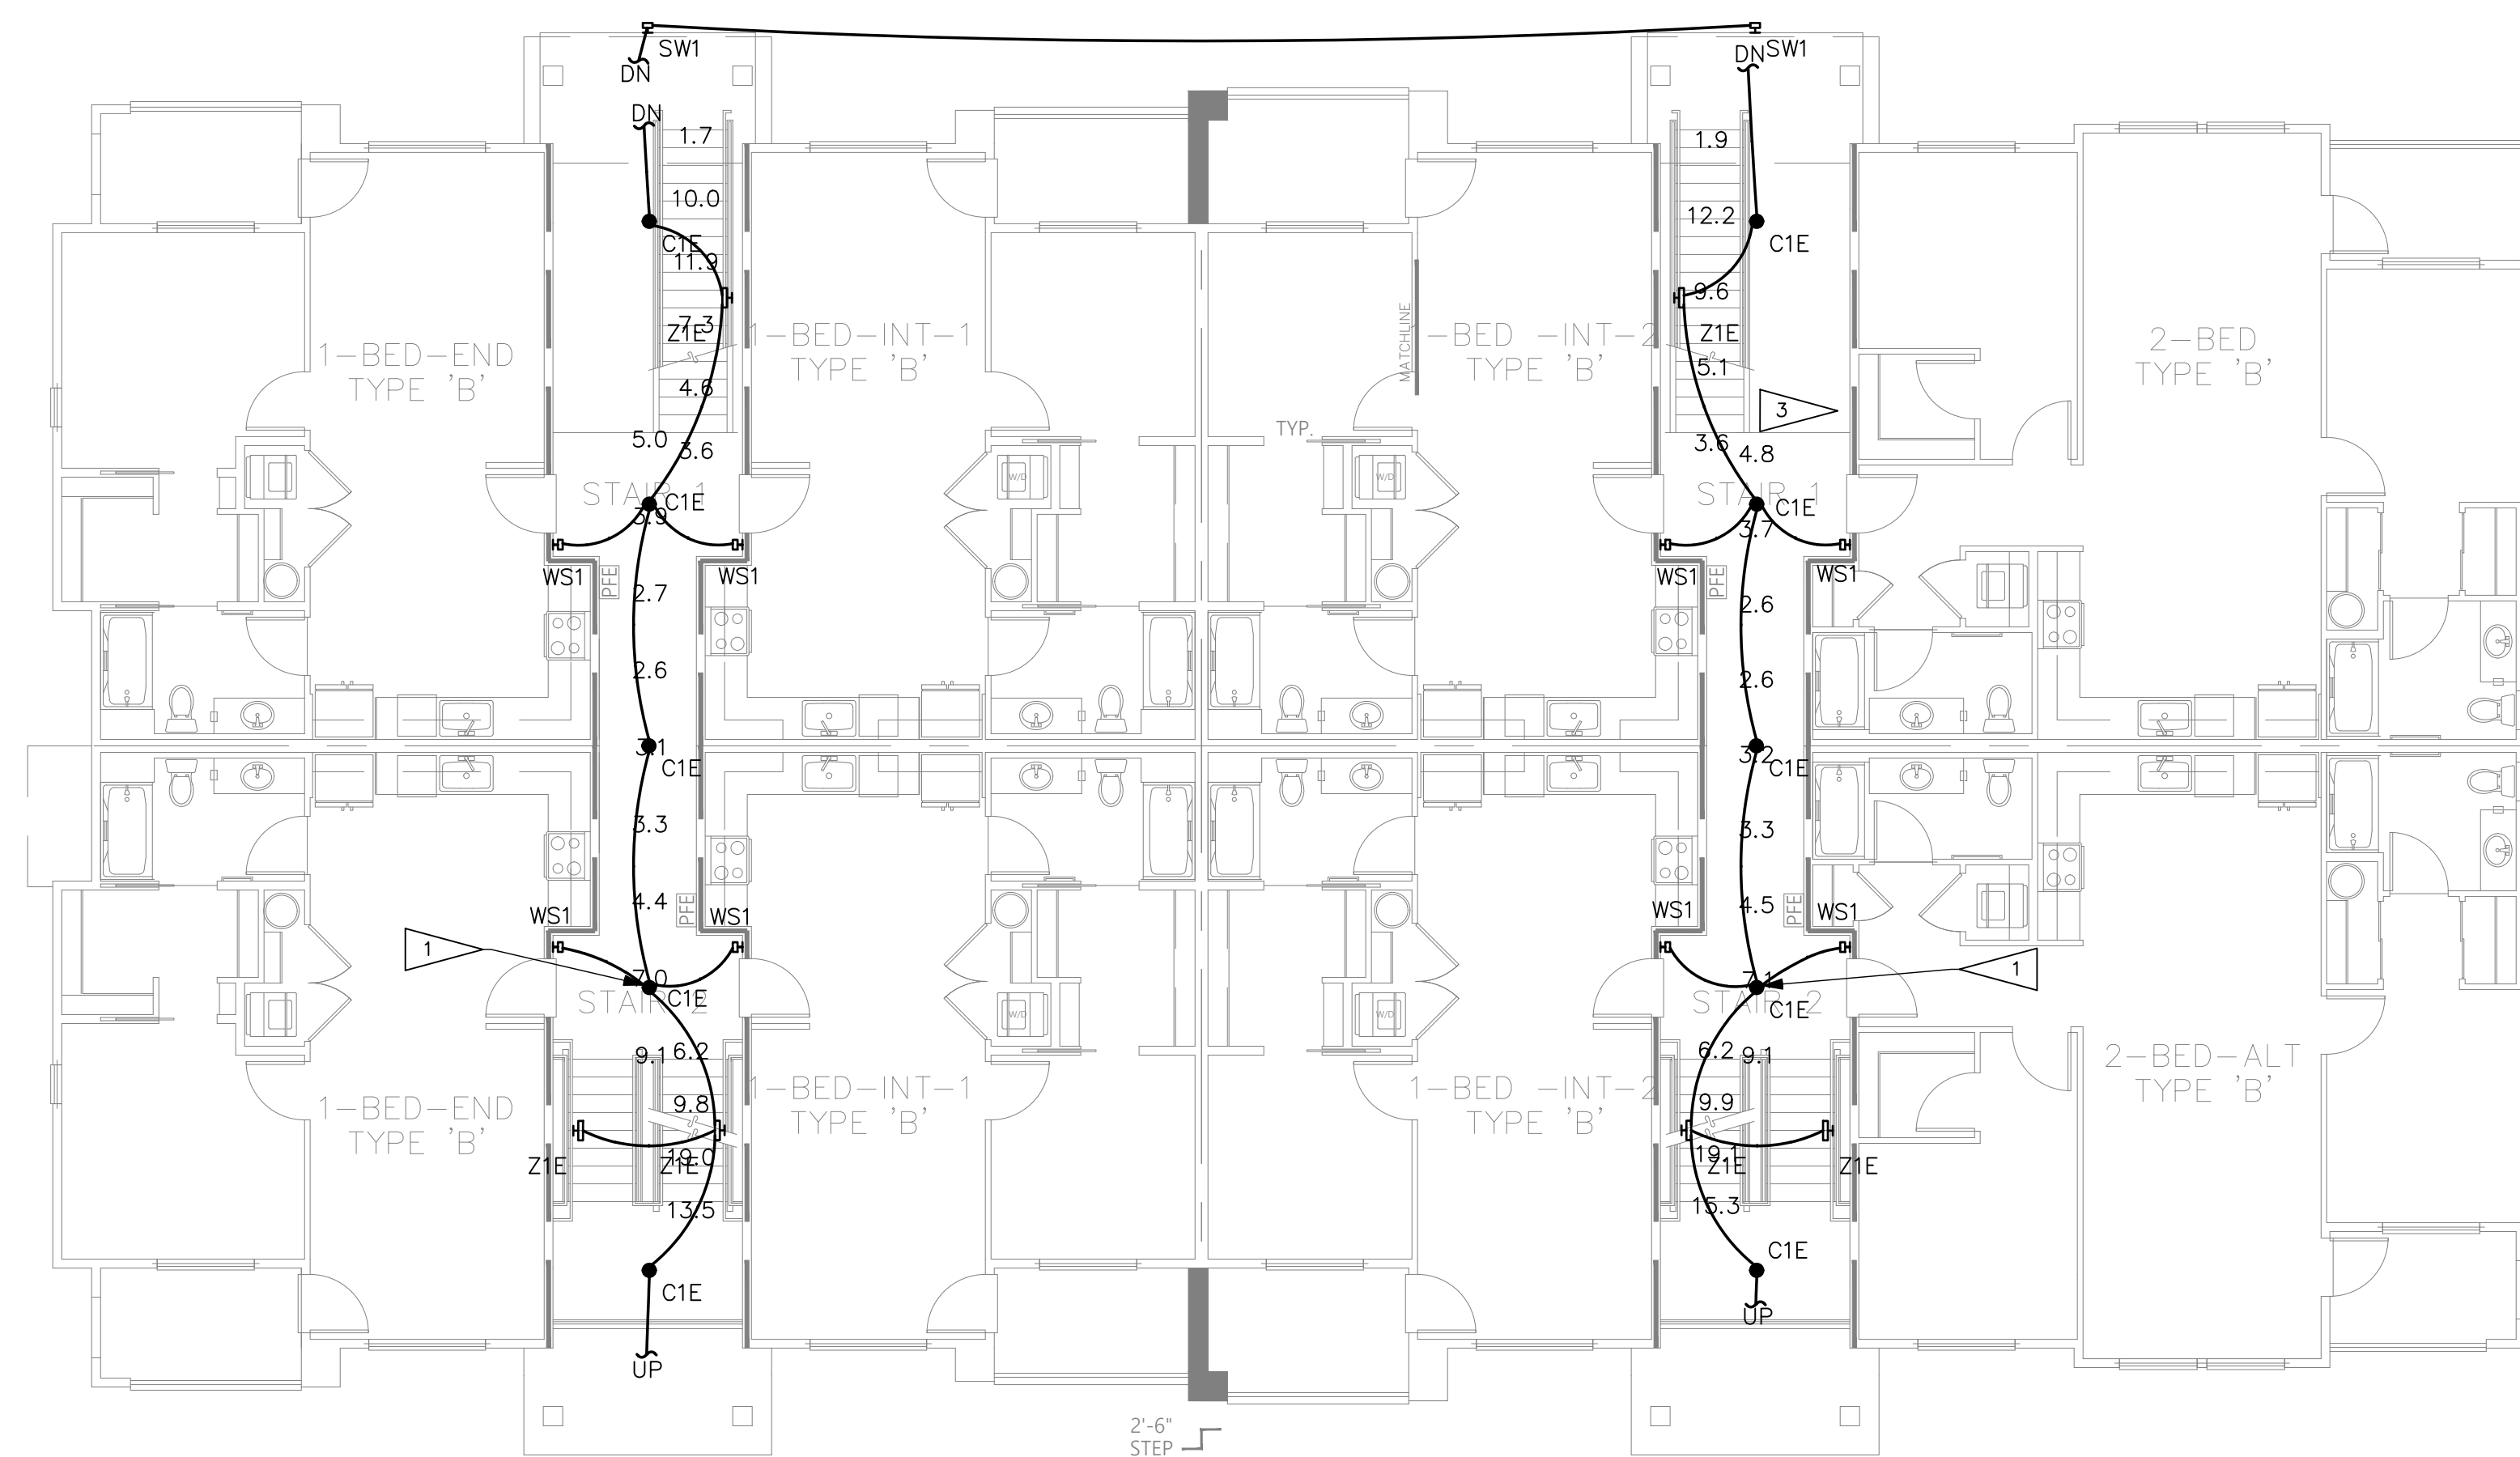

PHOTOMETRIC PLAN – 1ST FLOOR

SCALE: 1/8" = 1'-0"



GENERAL NOTES

- EMERGENCY EGRESS LIGHTING: EMERGENCY LUMINAIRE(S) WITH 90 MINUTE BATTERY BACKUP.
- REFER TO SERIES E500 DRAWINGS FOR TYPICAL UNIT PLANS SHOWING ELECTRICAL AND LIGHTING LAYOUT.
- SEE SHEET E1.50 FOR LUMINAIRE SCHEDULE AND LIGHTING NOTES.

FLAG NOTES

- CIRCUIT STAIRS VERTICALLY. LUMINAIRE(S) IN STAIRWELL
- EXIT SIGNS: PROVIDE UNSWITCHED HOT.

Egress Corridor Photometric Schedule

AVERAGE FOOT-CANDLES	4.56
MAXIMUM FOOT-CANDLES	9.1
MINIMUM FOOT-CANDLES	2.6
MINIMUM TO MAXIMUM FC RATIO	0.28
MAXIMUM TO MINIMUM FC RATIO	3.52
AVERAGE TO MINIMUM FC RATIO	1.77


Egress Stairs Photometric Schedule

AVERAGE FOOT-CANDLES	12.13
MAXIMUM FOOT-CANDLES	19.0
MINIMUM FOOT-CANDLES	6.2
MINIMUM TO MAXIMUM FC RATIO	0.32
MAXIMUM TO MINIMUM FC RATIO	3.09
AVERAGE TO MINIMUM FC RATIO	1.97

Egress Long Stairs Photometric Schedule

AVERAGE FOOT-CANDLES	6.52
MAXIMUM FOOT-CANDLES	11.9
MINIMUM FOOT-CANDLES	1.7
MINIMUM TO MAXIMUM FC RATIO	0.14
MAXIMUM TO MINIMUM FC RATIO	7.13
AVERAGE TO MINIMUM FC RATIO	3.90

NO.	DATE	DESCRIPTION	REVISIONS



DRAWN:	KL
DESIGNED:	MHS
CHECKED:	PSR
APPROVED:	JAY

PROJECT: BRADLEY HEIGHTS APARTMENTS
 27TH AVE SE AND 5TH ST BELLEVUE, WA


19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343

ROBISON ENGINEERING, INC.

DATE: 02/15/24



SHEET TITLE:
LIGHTING & PHOTOMETRIC PLAN - 1ST FLOOR

SHEET NO.
E1.01

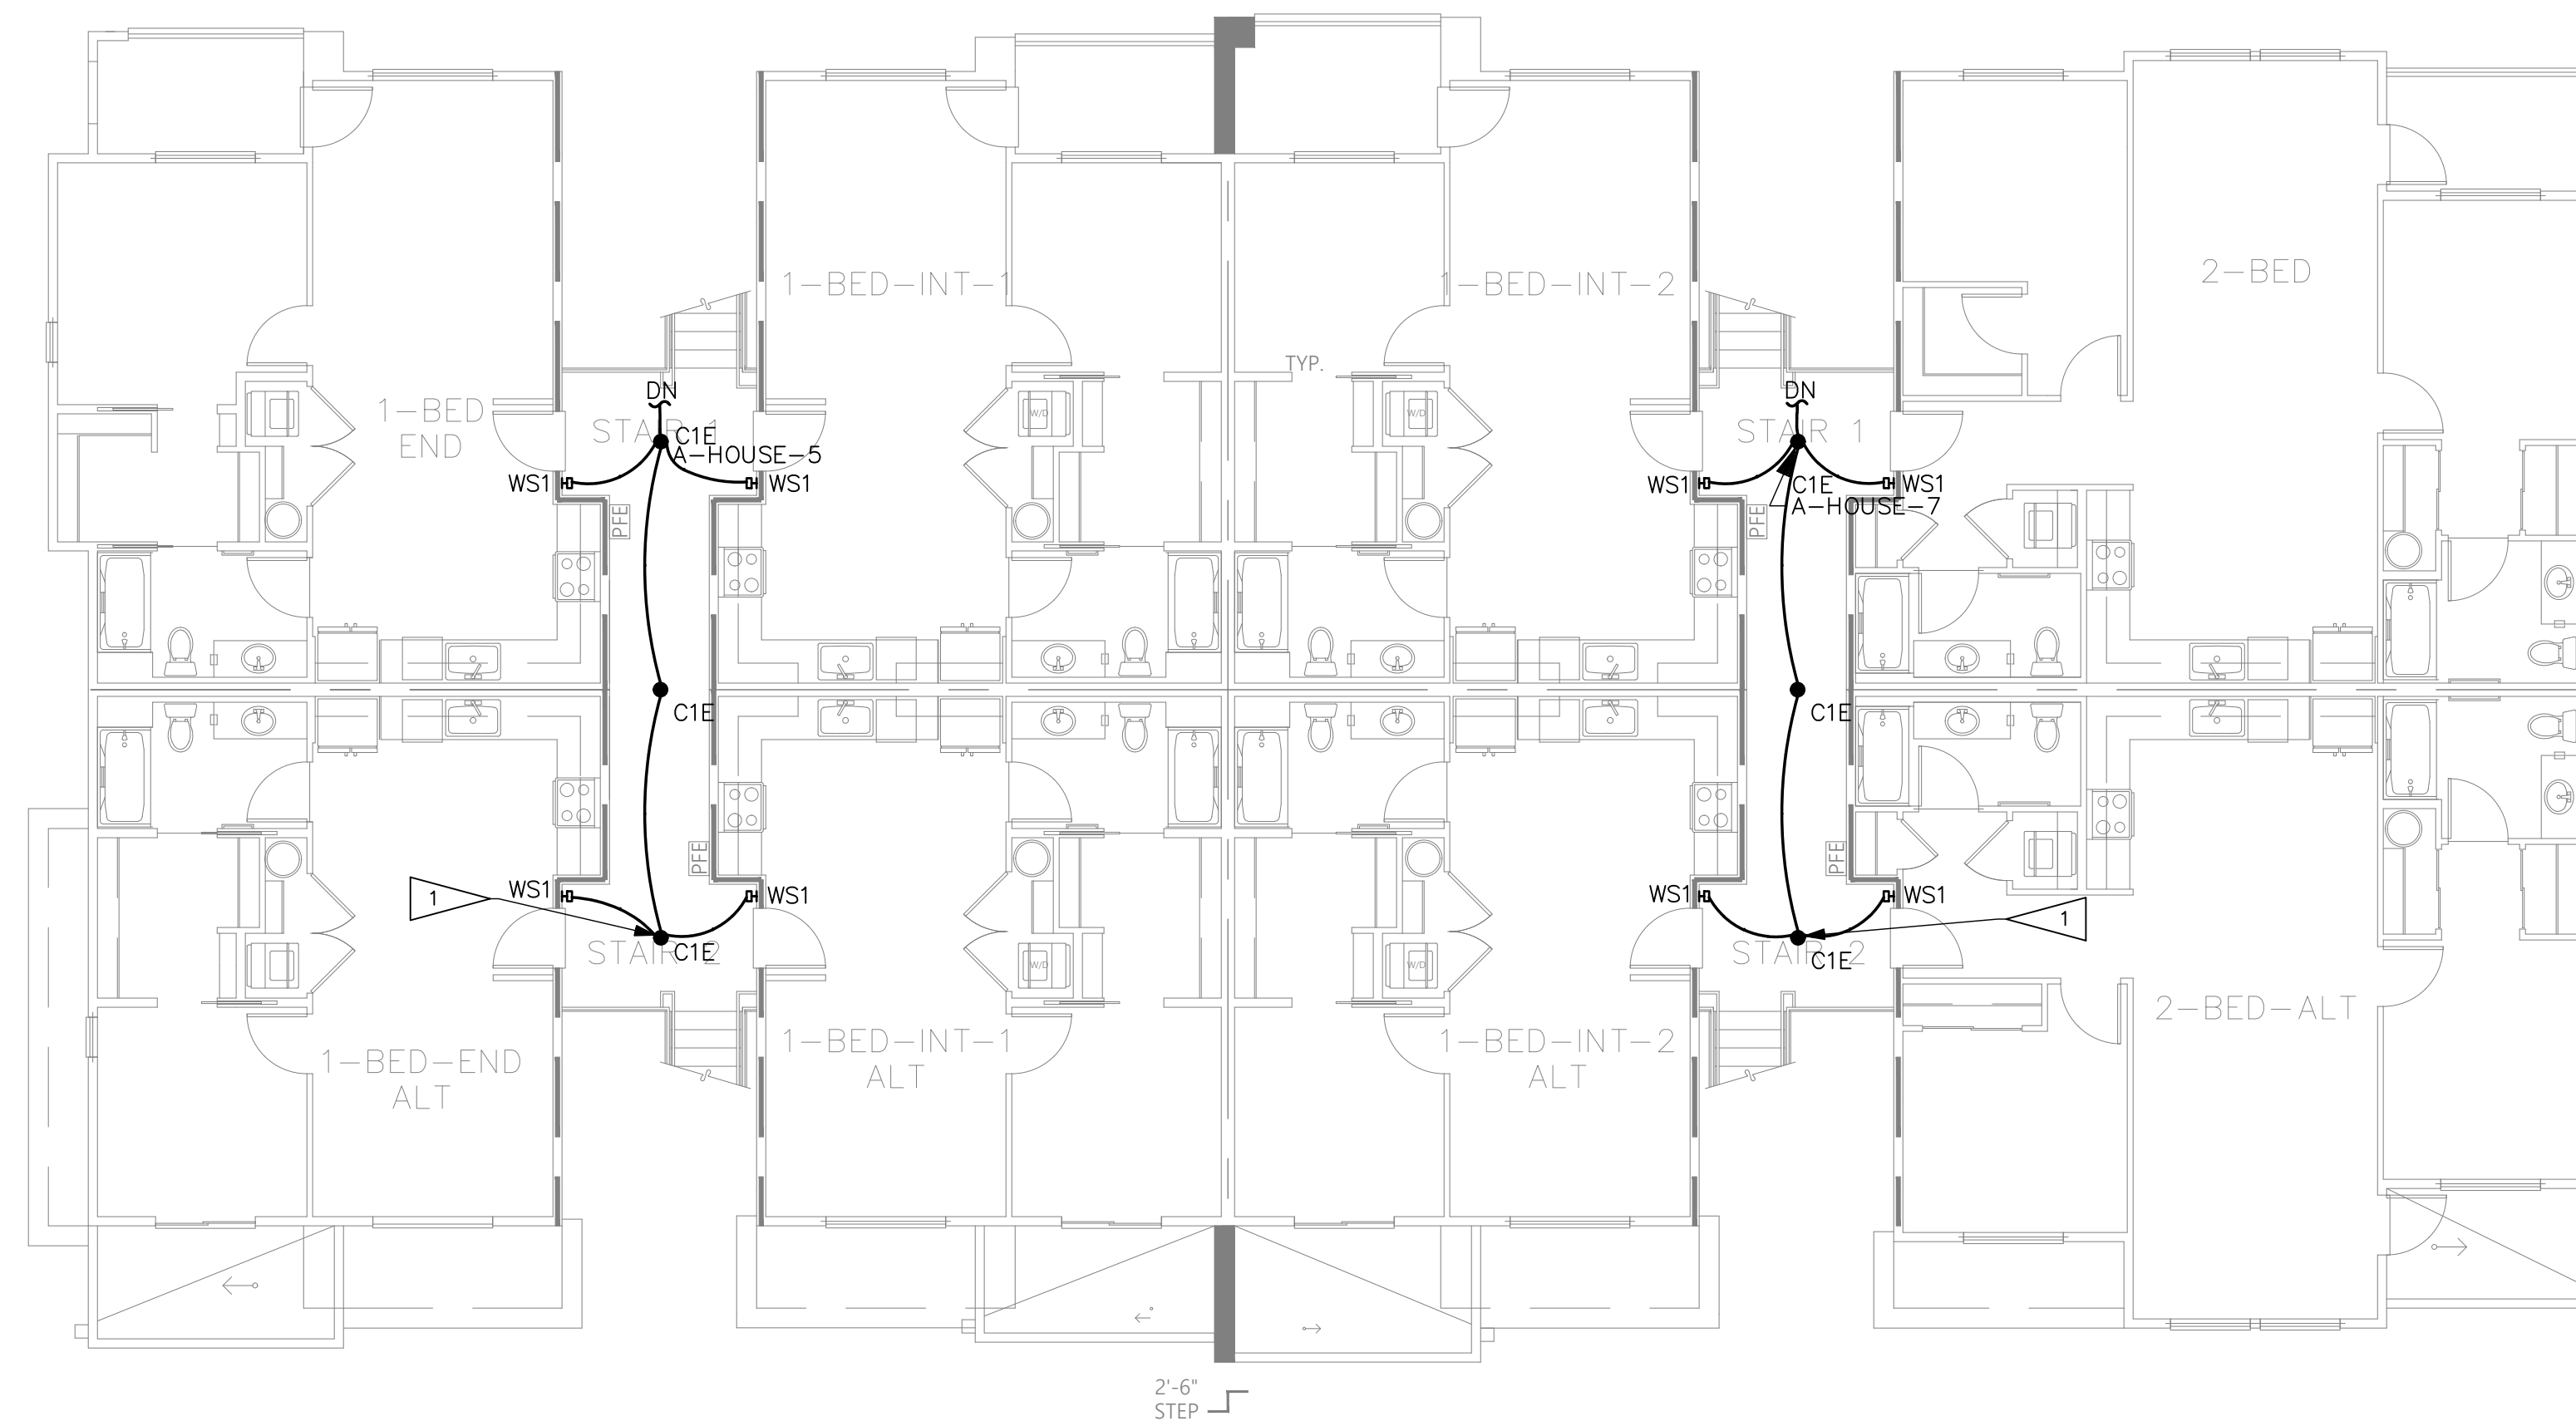


LIGHTING PLAN – 3RD FLOOR

SCALE: 1/8" = 1'-0"

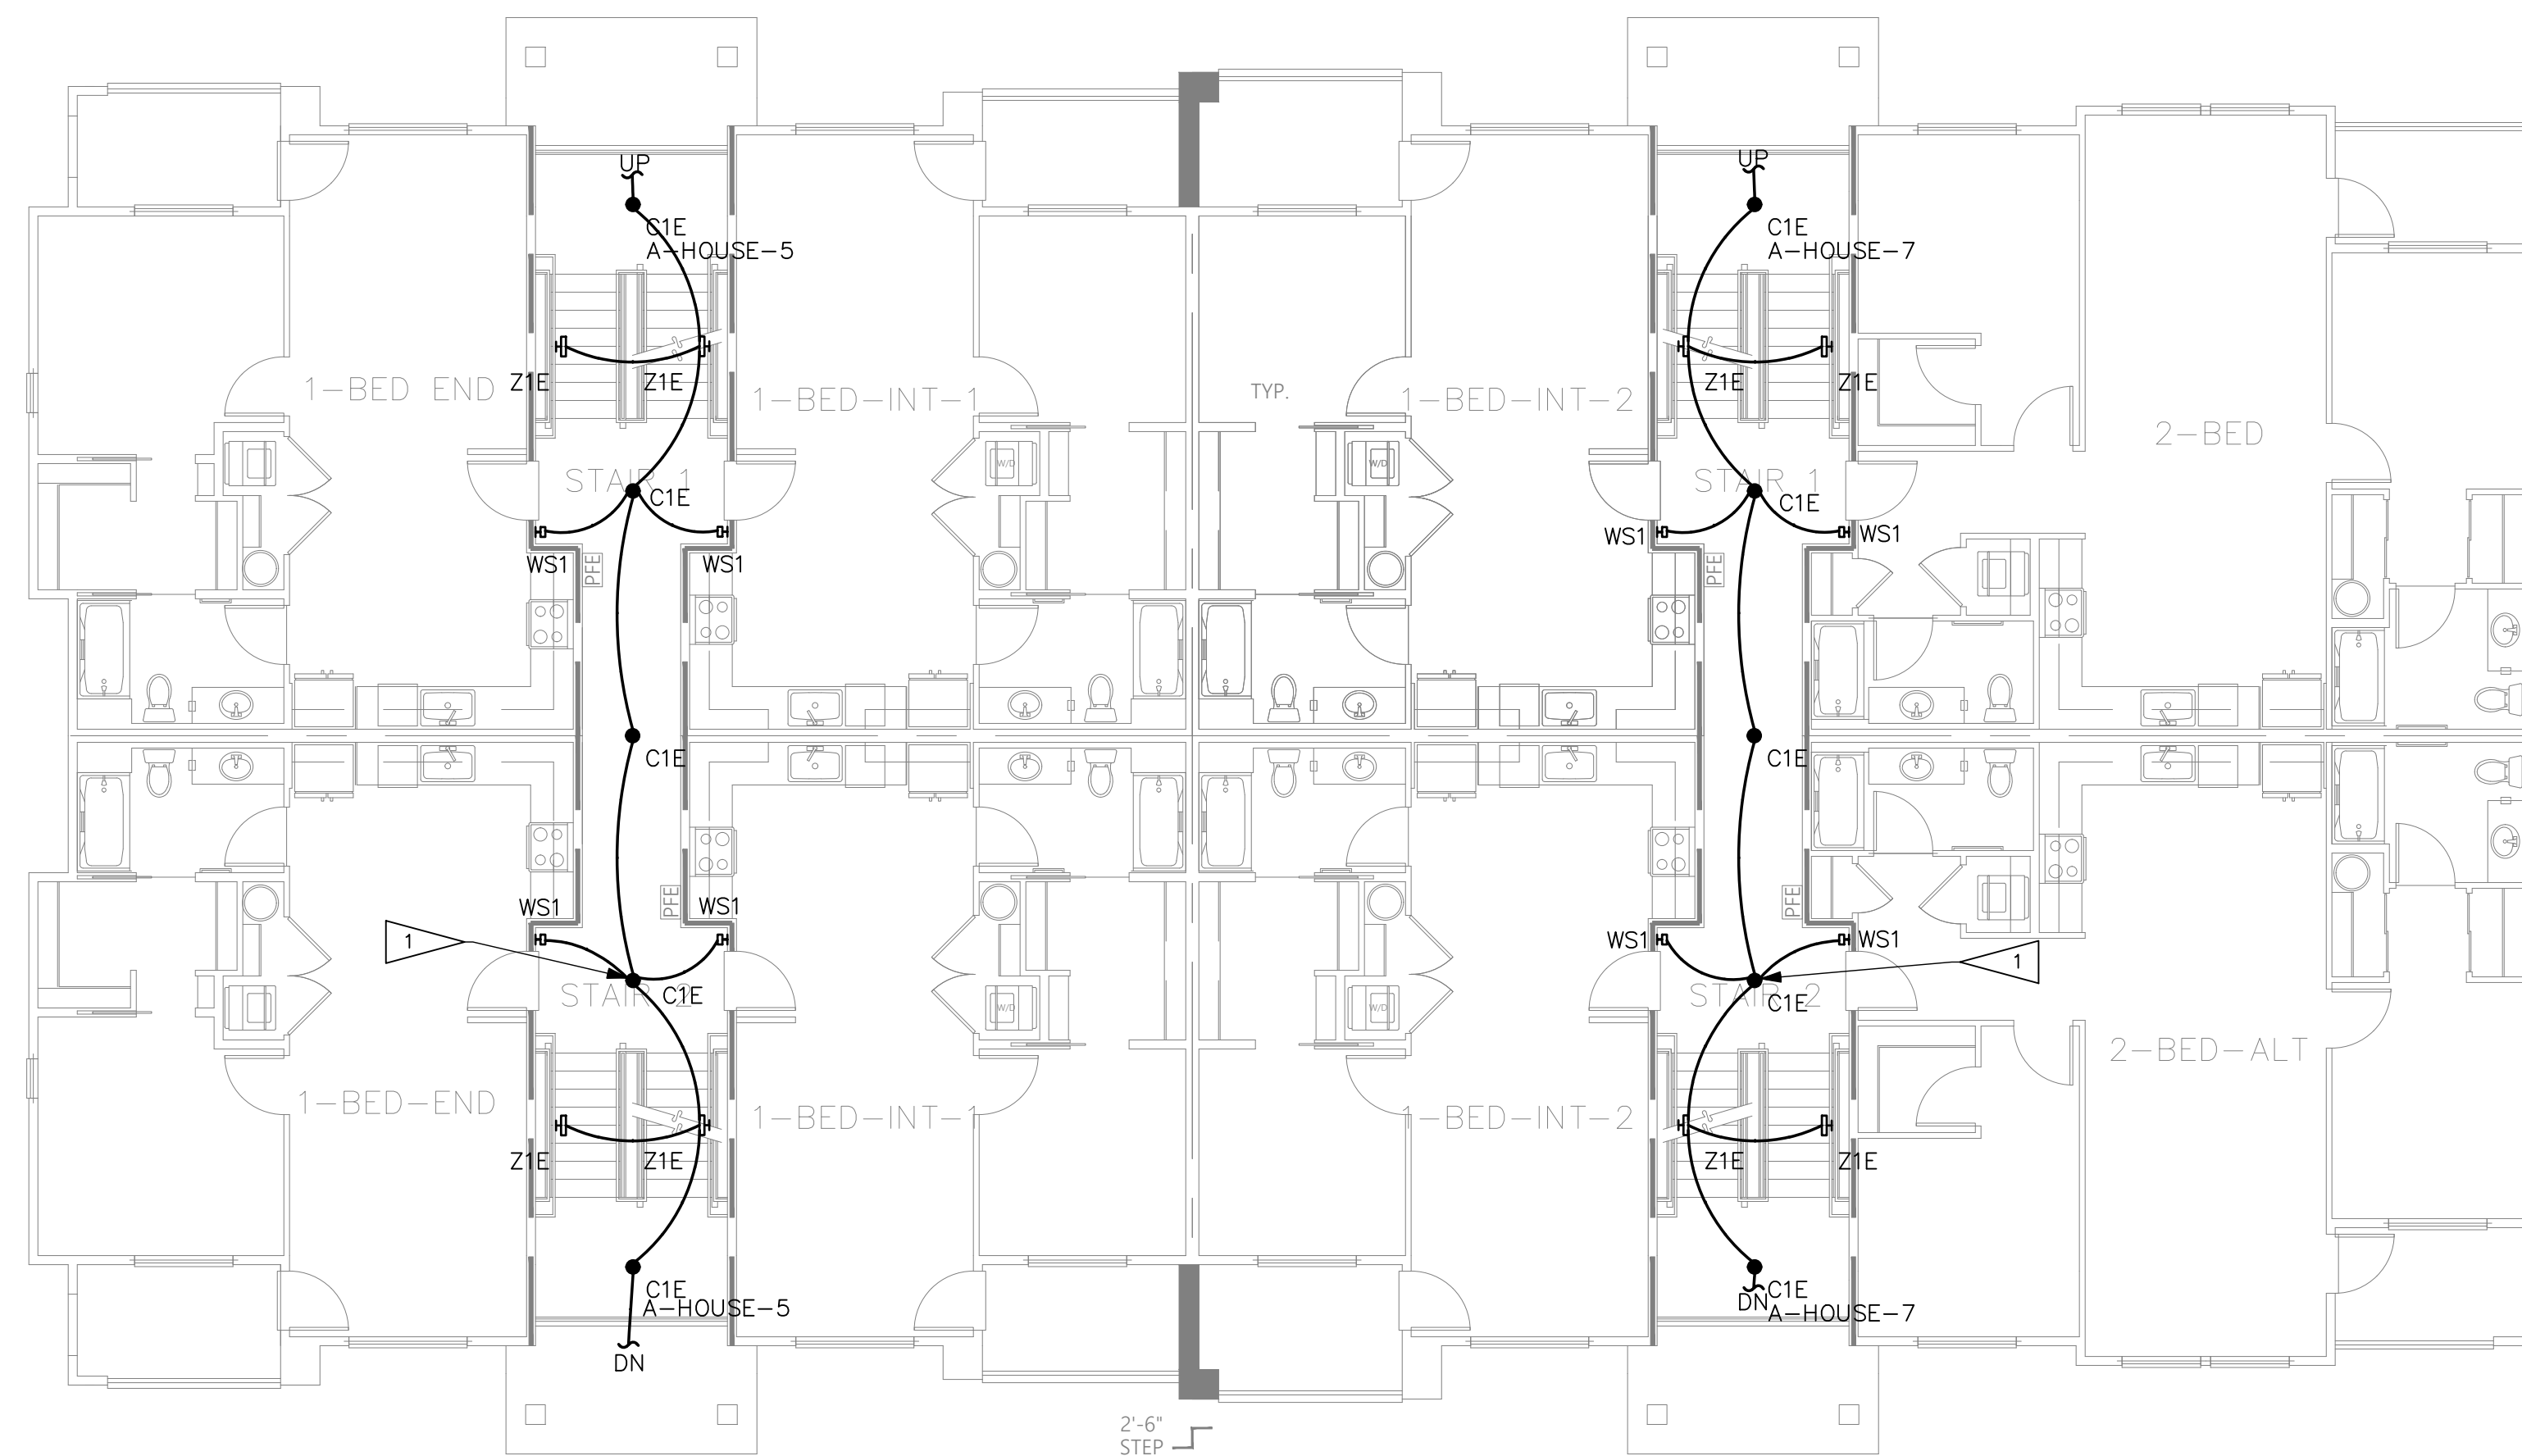

LIGHTING PLAN – 2ND FLOOR

SCALE: 1/8" = 1'-0"




GENERAL NOTES

1. EMERGENCY EGRESS LIGHTING: EMERGENCY LUMINAIRES WITH 90 MINUTE BATTERY BACKUP.
2. REFER TO SERIES E500 DRAWINGS FOR TYPICAL UNIT PLANS SHOWING ELECTRICAL AND LIGHTING LAYOUT.
3. SEE SHEET E1.50 FOR LUMINAIRE SCHEDULE AND LIGHTING NOTES.

FLAG NOTES

1. CIRCUIT STAIRS VERTICALLY. LUMINAIRE(S) IN STAIRWELL
2. EXIT SIGNS: PROVIDE UNSWITCHED HOT.

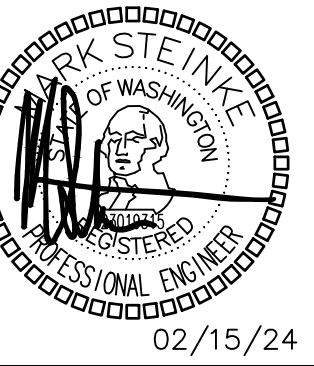

DRAWN:	KL
DESIGNED:	MHS
CHECKED:	PSR
APPROVED:	JAY

PROJECT: BRADLEY HEIGHTS APARTMENTS
 27TH AVE SE AND 5TH ST BELLEVUE, WA

DATE: 02/15/24

SHEET TITLE:
 LIGHTING PLAN - 2ND & 3RD FLOOR

SHEET NO.
 E1.02

EXTERIOR LUMINAIRE SCHEDULE

CALLOUT	SYMBOL	MOUNTING	DESCRIPTION	MODEL	VOLTAGE	TYPE	CRI / CCT	LAMPING	WATTAGE
SP1		16' POLE	POLE LIGHT - PARKING & DRIVE AISLE - COMFORT OPTICS - B2 U0 G2	GARDCO: P20 C A02 B30 T1S AR1 120 BL30-MW PCB	MULTIPLE	INTEGRAL CONTROLS	80 / 3000K	(1) 36W LED	36
SW1		SURFACE - 12' AFF	WALL SCONCE - AREA LIGHT - B1 U0 G1	GARDCO: GWM A06 830 T3M 120 MW30 PCB	120	INTEGRAL CONTROLS	80 / 3000K	(1) 16W LED	16

- NOTES:
- CONTRACTOR TO FURNISH AND INSTALL ALL FIXTURES.
 - LUMINAIRE SCHEDULE IS BOD ONLY. CONTRACTOR TO SUBMIT FIXTURE MODEL OR EQUIVALENT. CONTRACTOR TO COORDINATE FIXTURE FINISHES WITH ARCHITECT/OWNER.
 - FIXTURE CATALOG NUMBERS DO NOT NECESSARILY DENOTE SPECIFIC MOUNTING ACCESSORIES. CONTRACTOR TO PROVIDE ALL NECESSARY ACCESSORIES TO SUCCESSFULLY COMPLETE THE INSTALLATION.
 - 'BUG' RATING ON EXTERIOR FIXTURES INDICATES 'BACKLIGHT', 'UPLIGHT', AND 'GLARE' AS STANDARDS IN CLASSIFYING OUTDOOR LIGHT FIXTURES.

GENERAL LUMINAIRE SCHEDULE

CALLOUT	SYMBOL	MOUNTING	DESCRIPTION	MODEL	VOLTAGE	TYPE	CRI / CCT	LAMPING	WATTAGE
B1		SURFACE	4' NARROW WRAP - BOH	DAY-BRITE CF: FSW440L835 UNV DIM	120	0-10V DIMMING	80 / 3000K	(1) 31.4W LED	31.4
C1E		SURFACE	4" SURFACE DOWNLIGHT	DMF: DRDH N JO 70S EM / DRD5S 4 R 07 9 30 EM	120	0-10V DIMMING	90 / 3000K	(1) 9W LED	9
D1		RECESSED	RECESSED DOWNLIGHT - SLOPED CEILING	DMF: DRD4M 10 9 30 FL X 0 / DRDH N JS 1004	120	0-10V DIMMING	90 / 3000K	(1) 12W LED	12
P1		PENDANT	STEM MOUNT DOWNLIGHT - SLOPED CEILING - 4' STEM	DMF: DCR T4 S X A 30 FL 0 00 30 XX 0 00 [FINISH]	120	0-10V DIMMING	90 / 3000K	(1) 40W LED	40
WS1		SURFACE	WALL SCONCE - EM BATTERY BACKUP	TBD	120	TBD DIMMING	TBD / TBD	(1) 5W LED	5
X1		SURFACE	EXIT SIGN - EMERGENCY BATTERY BACKUP - HATCH INDICATES LIT FACE	LSI: EMS WB SERIES (OR EQUAL)	MULTIPLE	EM	EM / EM	(1) 5W EM	5
X2		SURFACE	COMBO EXIT SIGN	LSI: CEC (OR EQUAL)	MULTIPLE	EM	EM / EM	(1) 5W EM	5
X3		SURFACE	EMERGENCY LIGHT - EMERGENCY BATTERY BACKUP DAMP LOCATION RATED - MAX 35' SPACING	LITHONIA: ELM2LF (OR EQUAL)	120	EM	EM / EM	(1) 5W EM	5
X4		WALL	EXTERIOR EMERGENCY LIGHT - EMERGENCY ON ONLY - MAX SPACING 35'	NORA LIGHTING: NE-902LED	120	EM	35' MAX SPACING	(1) 5W LED	5
Z1E		WALL	WALL PACK	LITHONIA: WPX1 LED P1 30K MVOLT	120	EM	70 / 3000K	(1) 11W LED	11

- NOTES:
- CONTRACTOR TO FURNISH AND INSTALL ALL FIXTURES.
 - LUMINAIRE SCHEDULE IS BOD ONLY. CONTRACTOR TO SUBMIT FIXTURE MODEL OR EQUIVALENT. CONTRACTOR TO COORDINATE FIXTURE FINISHES WITH ARCHITECT/OWNER.
 - FIXTURE CATALOG NUMBERS DO NOT NECESSARILY DENOTE SPECIFIC MOUNTING ACCESSORIES. CONTRACTOR TO PROVIDE ALL NECESSARY ACCESSORIES TO SUCCESSFULLY COMPLETE THE INSTALLATION.

LIGHTING CONTROLS LEGEND

SYMBOL	CONTROL TYPE	CONTROL FUNCTION
	TOGGLE SWITCH	MANUAL ON/OFF LIGHTING CONTROL. SUBSCRIPT INDICATES WHICH FIXTURES ARE TO BE CONTROLLED BY WHICH SWITCH (WSEC C405.2.3). SUBSCRIPT 'k' INDICATES TAMPER RESISTANT KEYED SWITCH FOR USE BY AUTHORIZED PERSONNEL ONLY.
	DIMMER SWITCH	MANUAL MULTI-LEVEL LIGHTING CONTROL. SWITCH SHALL ALSO HAVE MANUAL ON/OFF FUNCTIONALITY. SUBSCRIPT INDICATES WHICH FIXTURES ARE TO BE CONTROLLED BY WHICH DIMMER. (C405.2.3)
	TOGGLE/DIMMER SWITCH WITH OCCUPANCY SENSOR	SWITCHES LABELED 'os' OR 'vs' SHALL TURN OFF ALL CONNECTED LUMINAIRES WITHIN 20 MINUTES OF SPACE BEING VACANT. (C405.2.1.1)
	CONTROL STATION; SEE LIGHTING CONTROL ZONE TABLE ON PLANS.	MANUAL LOCAL LIGHTING CONTROL (C405.2.1.1). CONTROL STATION SHALL HAVE CAPACITY TO CONTROL MULTIPLE ZONES AND MULTIPLE SCENES AS NEEDED. SUBSCRIPT CORRESPONDS TO 'LIGHTING CONTROLS' TABLE ON PLANS.
	SURFACE MOUNTED OCCUPANCY SENSOR	AUTOMATIC LIGHTING CONTROL SHALL TURN OFF ALL CONNECTED LUMINAIRES WITHIN 20 MINUTES OF SPACE BEING VACANT. (C404.2.1.1)
	MULTIZONE PHOTOSENSOR	AUTOMATIC LIGHTING CONTROL SHALL AUTOMATICALLY ADJUST THE LIGHT OUTPUT OF ALL CONNECTED LUMINAIRES BASED ON THE DAYLIGHT LEVEL IN THE PRIMARY AND SECONDARY ZONES (C405.2.4). SUBSCRIPT INDICATES WHICH FIXTURES ARE TO BE CONTROLLED BY ZONE; 'x' INDICATES MULTIPLE ZONE CONTROL.

GENERAL LIGHTING NOTES

- LIGHTING CONTROLS SHALL BE INSTALLED WHICH MEET ALL REQUIREMENTS OF LOCAL ENERGY CODES.
- EMERGENCY LIGHT FIXTURES: IN ADDITION TO SWITCH-LEG, PROVIDE UNSWITCHED HOT TO SERVE INTERNAL BATTERY AND CHARGER.
- LOCATIONS OF OCCUPANCY SENSORS, PHOTO SENSORS, DIMMERS, AND SWITCHES ARE DIAGRAMMATIC. CONTRACTOR TO COORDINATE QUANTITIES AND OPTIMAL LOCATIONS WITH LIGHTING CONTROL MANUFACTURER AND ARCH/OWNER.
- AUTOMATIC LIGHTING SHUT-OFF CONTROLS SHALL BE PROVIDED BY LOCAL OCCUPANCY SENSORS UNLESS OTHERWISE NOTED. PUBLIC SPACES ARE ACTIVE 24/7 AND THEREFORE EXEMPT FROM AUTOMATIC LIGHTING SHUT-OFF REQUIREMENTS FOR SECURITY. (WSEC C405.2)
- DAYLIGHT ZONES ARE SHOWN ON PLANS AS DEFINED BY WASHINGTON STATE ENERGY CODE (WSEC) C405.2.4.2. SIDELIGHT DAYLIGHT ZONES ARE REFERRED TO AS 'PRIMARY' AND 'SECONDARY' ON PLANS AND DENOTED BY DASHED LINES.
- FOR CUSTOM FF&E FIXTURES, IT IS THE MANUFACTURER'S RESPONSIBILITY TO FURNISH PRODUCTS WHICH ARE COMPLIANT WITH ALL REQUIREMENTS OF LOCAL ENERGY CODES, AS WELL AS MATCH THE ELECTRICAL SPECIFICATIONS PROVIDED IN THE LUMINAIRE SCHEDULES. PROVIDE SUBMITTAL SHOP DRAWINGS WITHIN 30 DAYS OF RECEIVING FIXTURE ORDER. SUBMITTALS SHALL CLEARLY INDICATE LAMPING AND MAXIMUM WATTAGE RATING OF LAMP SOCKETS. NON-COMPLIANT FIXTURES REJECTED BY ELECTRICAL INSPECTOR SHALL BE RETURNED TO THE MANUFACTURER FOR REWORKING AND/OR RE-LABELING.
- ALL FIXTURES SHALL BE INSTALLED ACCORDING TO THE MANUFACTURER'S INSTRUCTIONS.
- CONTRACTOR SHALL BE RESPONSIBLE TO ORDER ALL NECESSARY HARDWARE, ELECTRICAL CABLE, TIMERS, TRANSFORMERS, ETC., AS REQUIRED FOR COMPLETION OF INSTALLATION OF A FULLY FUNCTIONING SYSTEM.
- CONTRACTOR SHALL BE RESPONSIBLE FOR EQUIPPING ALL FIXTURES WITH THE EXACT LAMPS SPECIFIED IN THE FIXTURE SCHEDULE.
- WHERE FIXTURES REQUIRE REMOTE TRANSFORMERS OR BALLASTS, THE CONTRACTOR SHALL DETERMINE LOCATIONS AS REQUIRED FOR EVEN LOAD DISTRIBUTION, SERVICE ACCESS, AND VENTILATION.
- THE CONTRACTOR SHALL COORDINATE WITH THE ELECTRICAL ENGINEER FOR EXACT LOCATIONS OF TIMERS AND/OR PHOTO CELLS, IF ANY.
- WHERE APPLICABLE, THE CONTRACTOR SHALL AIM AND ADJUST LIGHTING FIXTURES AS DIRECTED BY THE LIGHTING DESIGNER UPON COMPLETION OF THE INSTALLATION.

SPECIAL NOTE TO THE CONTRACTOR:

- FIXTURE SUBMITTALS THAT DO NOT INCLUDE LAMP SPECIFICATIONS WILL BE CONSIDERED INCOMPLETE AND WILL NOT BE REVIEWED.


LIGHTING CONTROL SYSTEM REQUIREMENTS

- CONTRACTOR TO PROVIDE A FULLY OPERATIONAL LIGHTING CONTROL SYSTEM.
- CONTRACTOR SHALL VERIFY THE COMPATIBILITY OF DIMMING AND CONTROL MODULES WITH FIXTURE TYPES PRIOR TO INSTALLATION.
- ELECTRICAL CONTRACTOR SHALL COORDINATE WITH A LIGHTING CONTROLS VENDOR TO OBTAIN LIGHTING CONTROL SYSTEM PACKAGE COMPLETE WITH DEVICES, WIRING DIAGRAMS, ANNOTATED PLANS INDICATING WHICH DEVICE TO BE USED IN EACH LOCATION, CONNECTION REQUIREMENTS, SET UP INSTRUCTIONS, COMMISSIONING AND CHECK-OUT FOLLOWING COMPLETION. PROVIDE ALL LOW VOLTAGE WIRING AS REQUIRED FOR CONTROL DEVICE INTERCONNECTIONS.
- INSTALLER QUALIFICATIONS: TECHNICIAN INSTALLING AND WIRING THE LIGHTING CONTROL SYSTEM SHALL HAVE INSTALLED THIS SAME SYSTEM AT LEAST ONCE PREVIOUSLY. TECHNICIAN SHALL HAVE RECEIVED TRAINING BY FACTORY REPRESENTATIVE ON THE SYSTEM BEING INSTALLED.
- PROVIDE LIGHTING CONTROL SYSTEM TO PERFORM THE FUNCTIONS DESCRIBED BELOW:
 - LIGHTING CONTROL SCHEDULE: PROVIDE SEPARATE SWITCHING AND DIMMING CONTROL FOR LIGHTING ZONES AS INDICATED.
 - AUTOMATIC LIGHTING CONTROLS:
 - UNLESS OTHERWISE NOTED ON PLANS, OCCUPANCY SENSORS SHALL AUTOMATICALLY TURN OFF ALL CONNECTED LIGHTING WITHIN 20 MINUTES OF SPACE BEING UNOCCUPIED. OCCUPANCY SENSORS SHALL EITHER BE MANUAL ON OR SHALL BE CONTROLLED TO AUTOMATICALLY TURN THE LIGHTING ON TO NOT MORE THAN 50 PERCENT POWER EXCEPT WHERE MANUAL ON WOULD ENDANGER THE SAFETY OR SECURITY OF THE ROOM OR BUILDING OCCUPANTS. (C405.2.1.1)
 - MULTI-ZONE PHOTO-SENSORS SHALL PROVIDE SEPARATE CONTROL FOR LUMINAIRES IN EACH TYPE OF DAYLIGHT ZONE. (C405.2.4.1)
 - EXTERIOR LIGHTING CONTROLS SHALL AUTOMATICALLY TURN OFF ALL EXTERIOR LIGHTING AS A FUNCTION OF AVAILABLE DAYLIGHT. BUILDING FACADE AND LANDSCAPE LIGHTING SHALL HAVE CONTROLS THAT AUTOMATICALLY SHUT OFF THE LIGHTING FOR A MINIMUM OF 6 HOURS PER NIGHT OR NOT LATER THAN ONE HOUR AFTER BUSINESS CLOSING TO NOT EARLIER THAN ONE HOUR BEFORE BUSINESS OPENING, WHICHEVER IS LESS. OTHER LIGHTING SHALL HAVE CONTROLS CONFIGURED TO AUTOMATICALLY REDUCE THE CONNECTED LIGHTING POWER BY AT LEAST 30 PERCENT FROM NO LATER THAN 12 MIDNIGHT TO 6 AM OR FROM ON HOUR AFTER BUSINESS CLOSING TO ONE HOUR BEFORE BUSINESS OPENING OR DURING ANY PERIOD WHEN NO ACTIVITY HAS BEEN DETECTED FOR A TIME OF NO LONGER THAN 15 MINUTES. (C405.2.6)
 - MEANS OF EGRESS ILLUMINATION: AT ANY TIME THE BUILDING IS OCCUPIED, THE MEANS OF EGRESS SHALL BE ILLUMINATED AT AN INTENSITY OF NOT LESS THAN 1 FOOTCANDLE AT FLOOR LEVEL. (IBC 1008.2.1)
 - DURING EMERGENCY CONDITIONS EMERGENCY LIGHTING CIRCUITS SHALL BYPASS ALL LIGHTING CONTROLS IN ORDER TO ENERGIZE ALL CONNECTED LUMINAIRES AT FULL CAPACITY. PROVIDE UL924 RELAYS AS REQUIRED TO BYPASS AREA CONTROLS.
 - EMERGENCY PATHWAY EGRESS LIGHTING: ILLUMINATION PROVIDED ALONG THE EGRESS PATH AT FLOOR LEVEL SHALL AVERAGE AT LEAST 1 FOOT CANDLE. (IBC 1008.3.5)
 - EMERGENCY LIGHTING SHALL BE SUPPLIED BY: ELECTRICAL CONTRACTOR

EXIT SIGN NOTES

DURING CONSTRUCTION UPON COMPLETION OF A TYPICAL FLOOR FRAMING AND BEFORE WALL COVER, ELECTRICAL CONTRACTOR SHALL WALK THE EGRESS PATHS WITH THE LOCAL INSPECTOR (AHJ) TO CONFIRM THAT ALL THE EXIT SIGNS ARE LOCATED PER THE AHJ'S SATISFACTION AND IDENTIFY ANY ADDITIONAL EXIT SIGNS THAT THE AHJ WISHES TO BE INSTALLED (IBC 1013.1). CONTRACTOR SHALL PROVIDE UP TO 10% ADDITIONAL EXIT SIGNS AT NO ADDITIONAL COST.

NO.	DATE	DESCRIPTION	REVISIONS

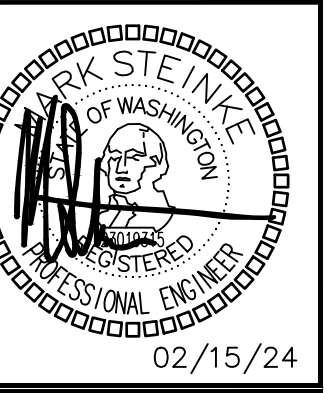

DRAWN: KL	DESIGNED: MHS	CHECKED: PSR	APPROVED: JAY
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHTS APARTMENTS
27TH AVE SE AND 5TH ST BELLEVUE, WA


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 364-3343

ROBISON ENGINEERING, INC.

DATE: 02/15/24



SHEET TITLE:
LIGHTING NOTES & LUMINAIRE SCHEDULE

SHEET NO.
E1.50

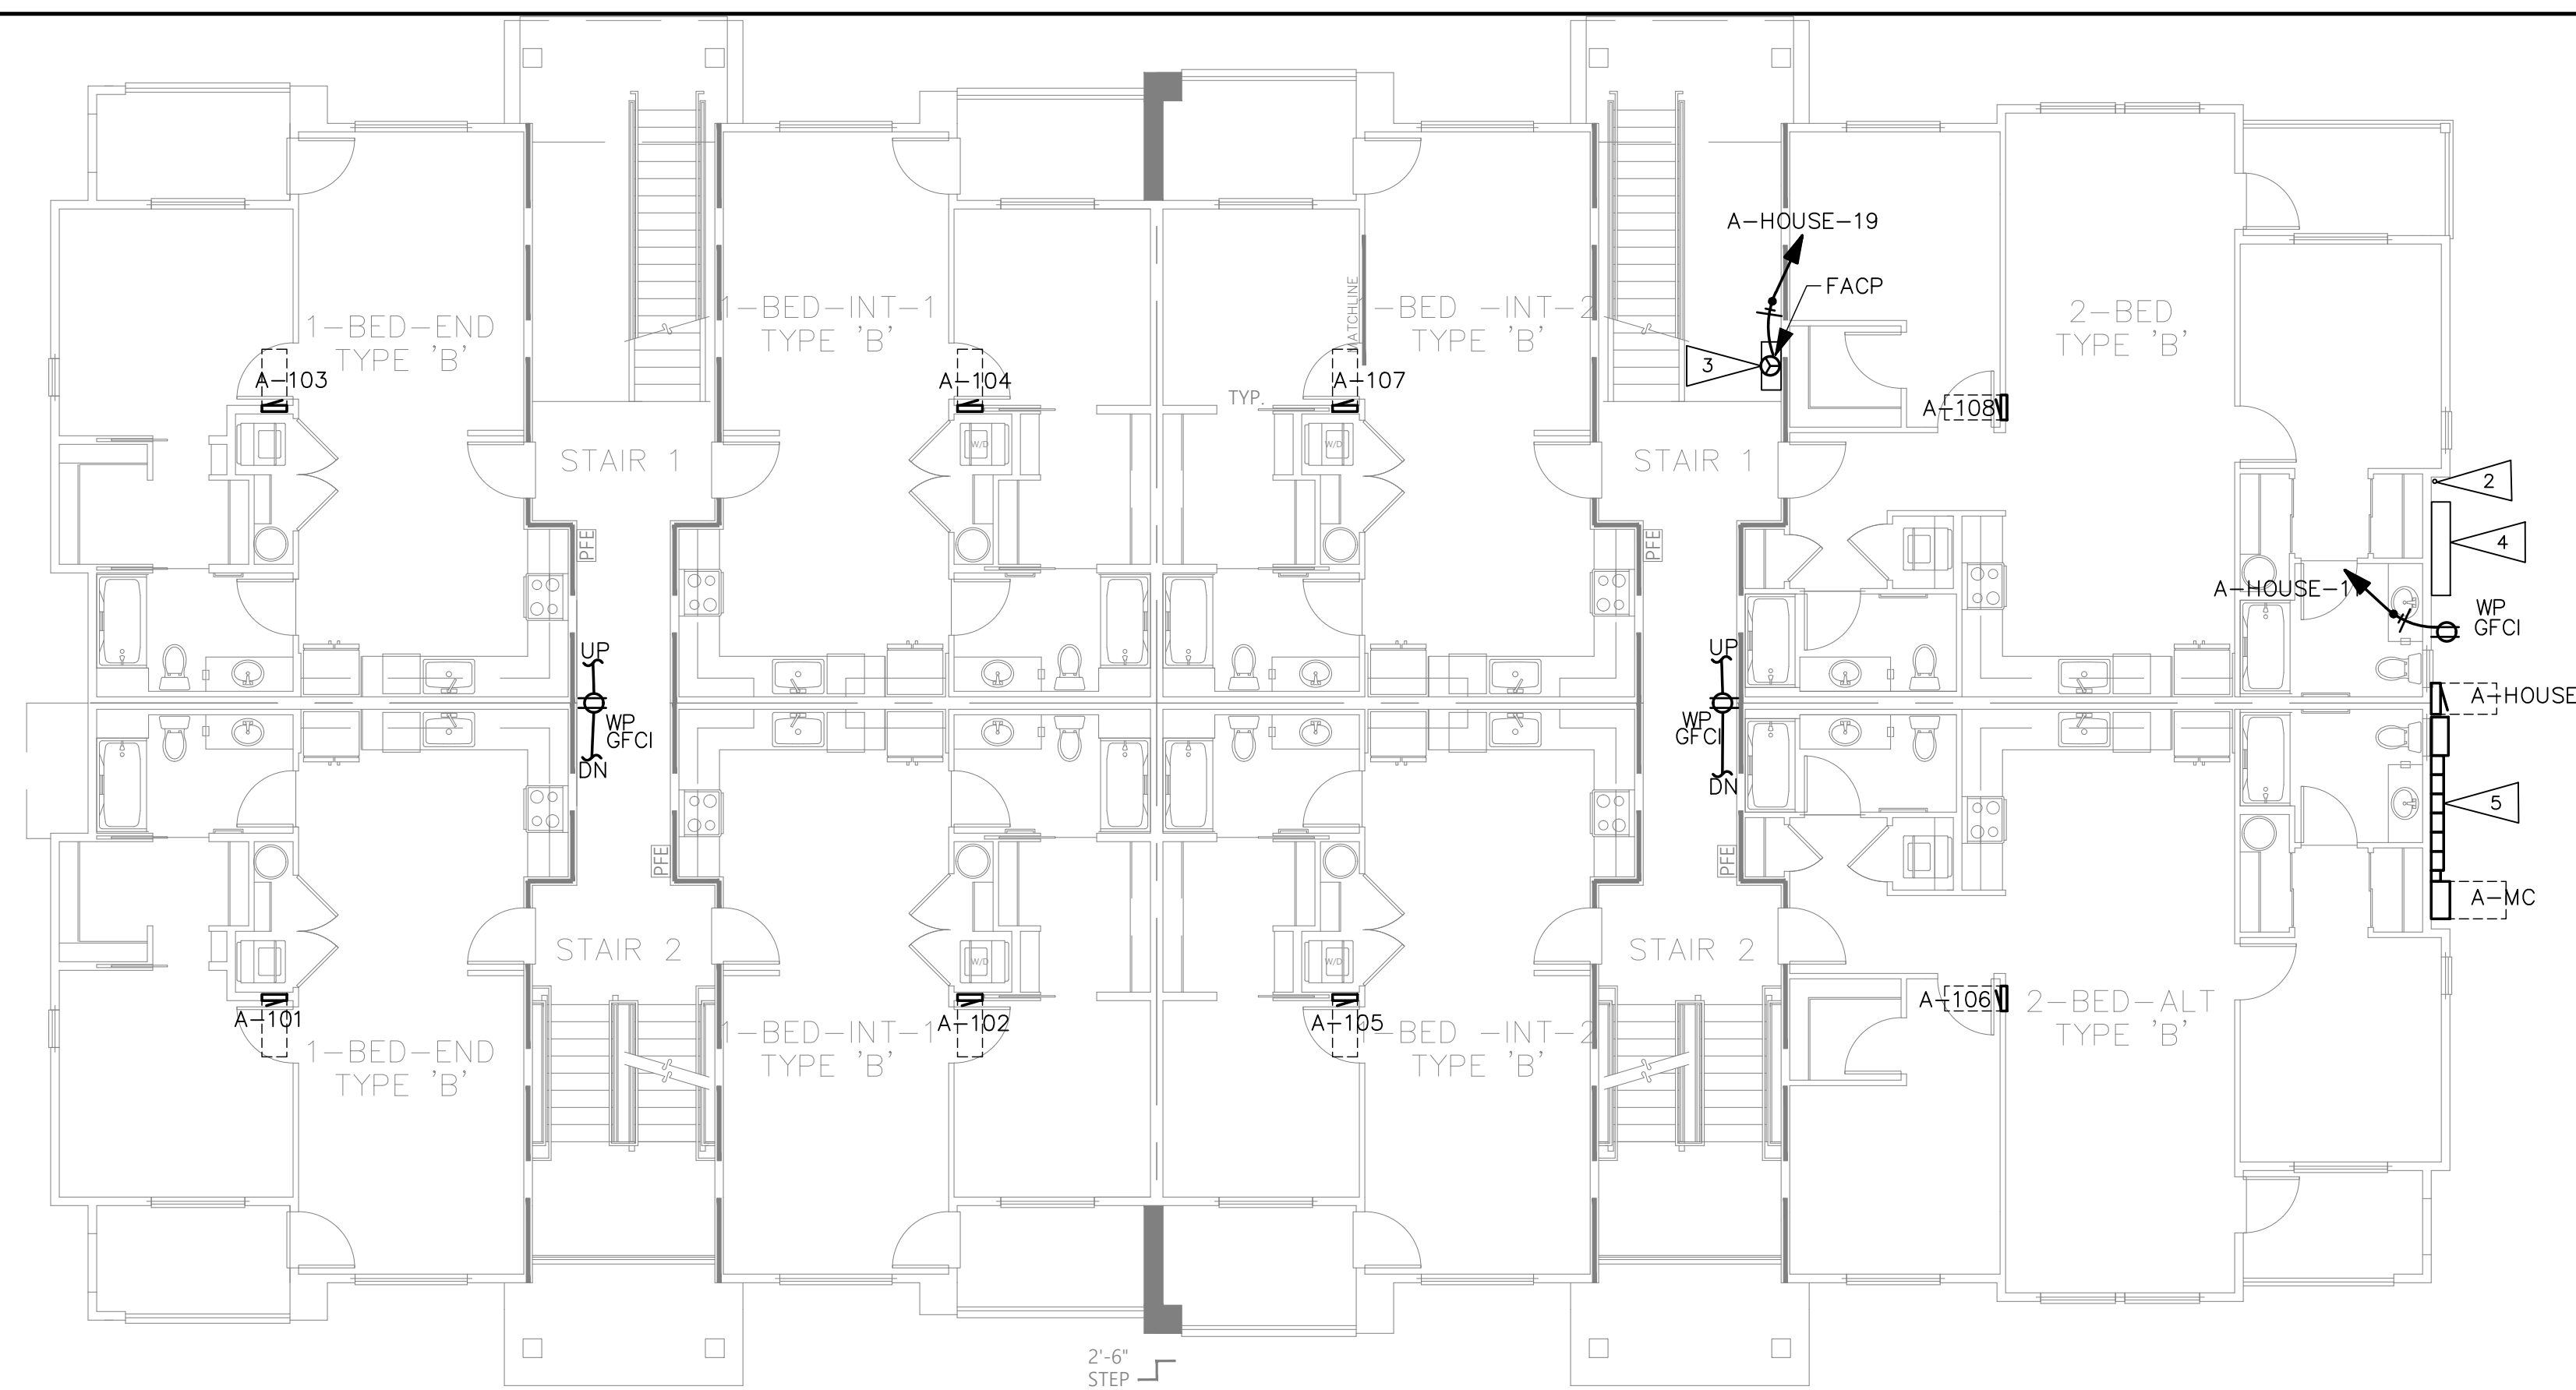


POWER PLAN - 1ST FLOOR

SCALE: 1/8" = 1'-0"

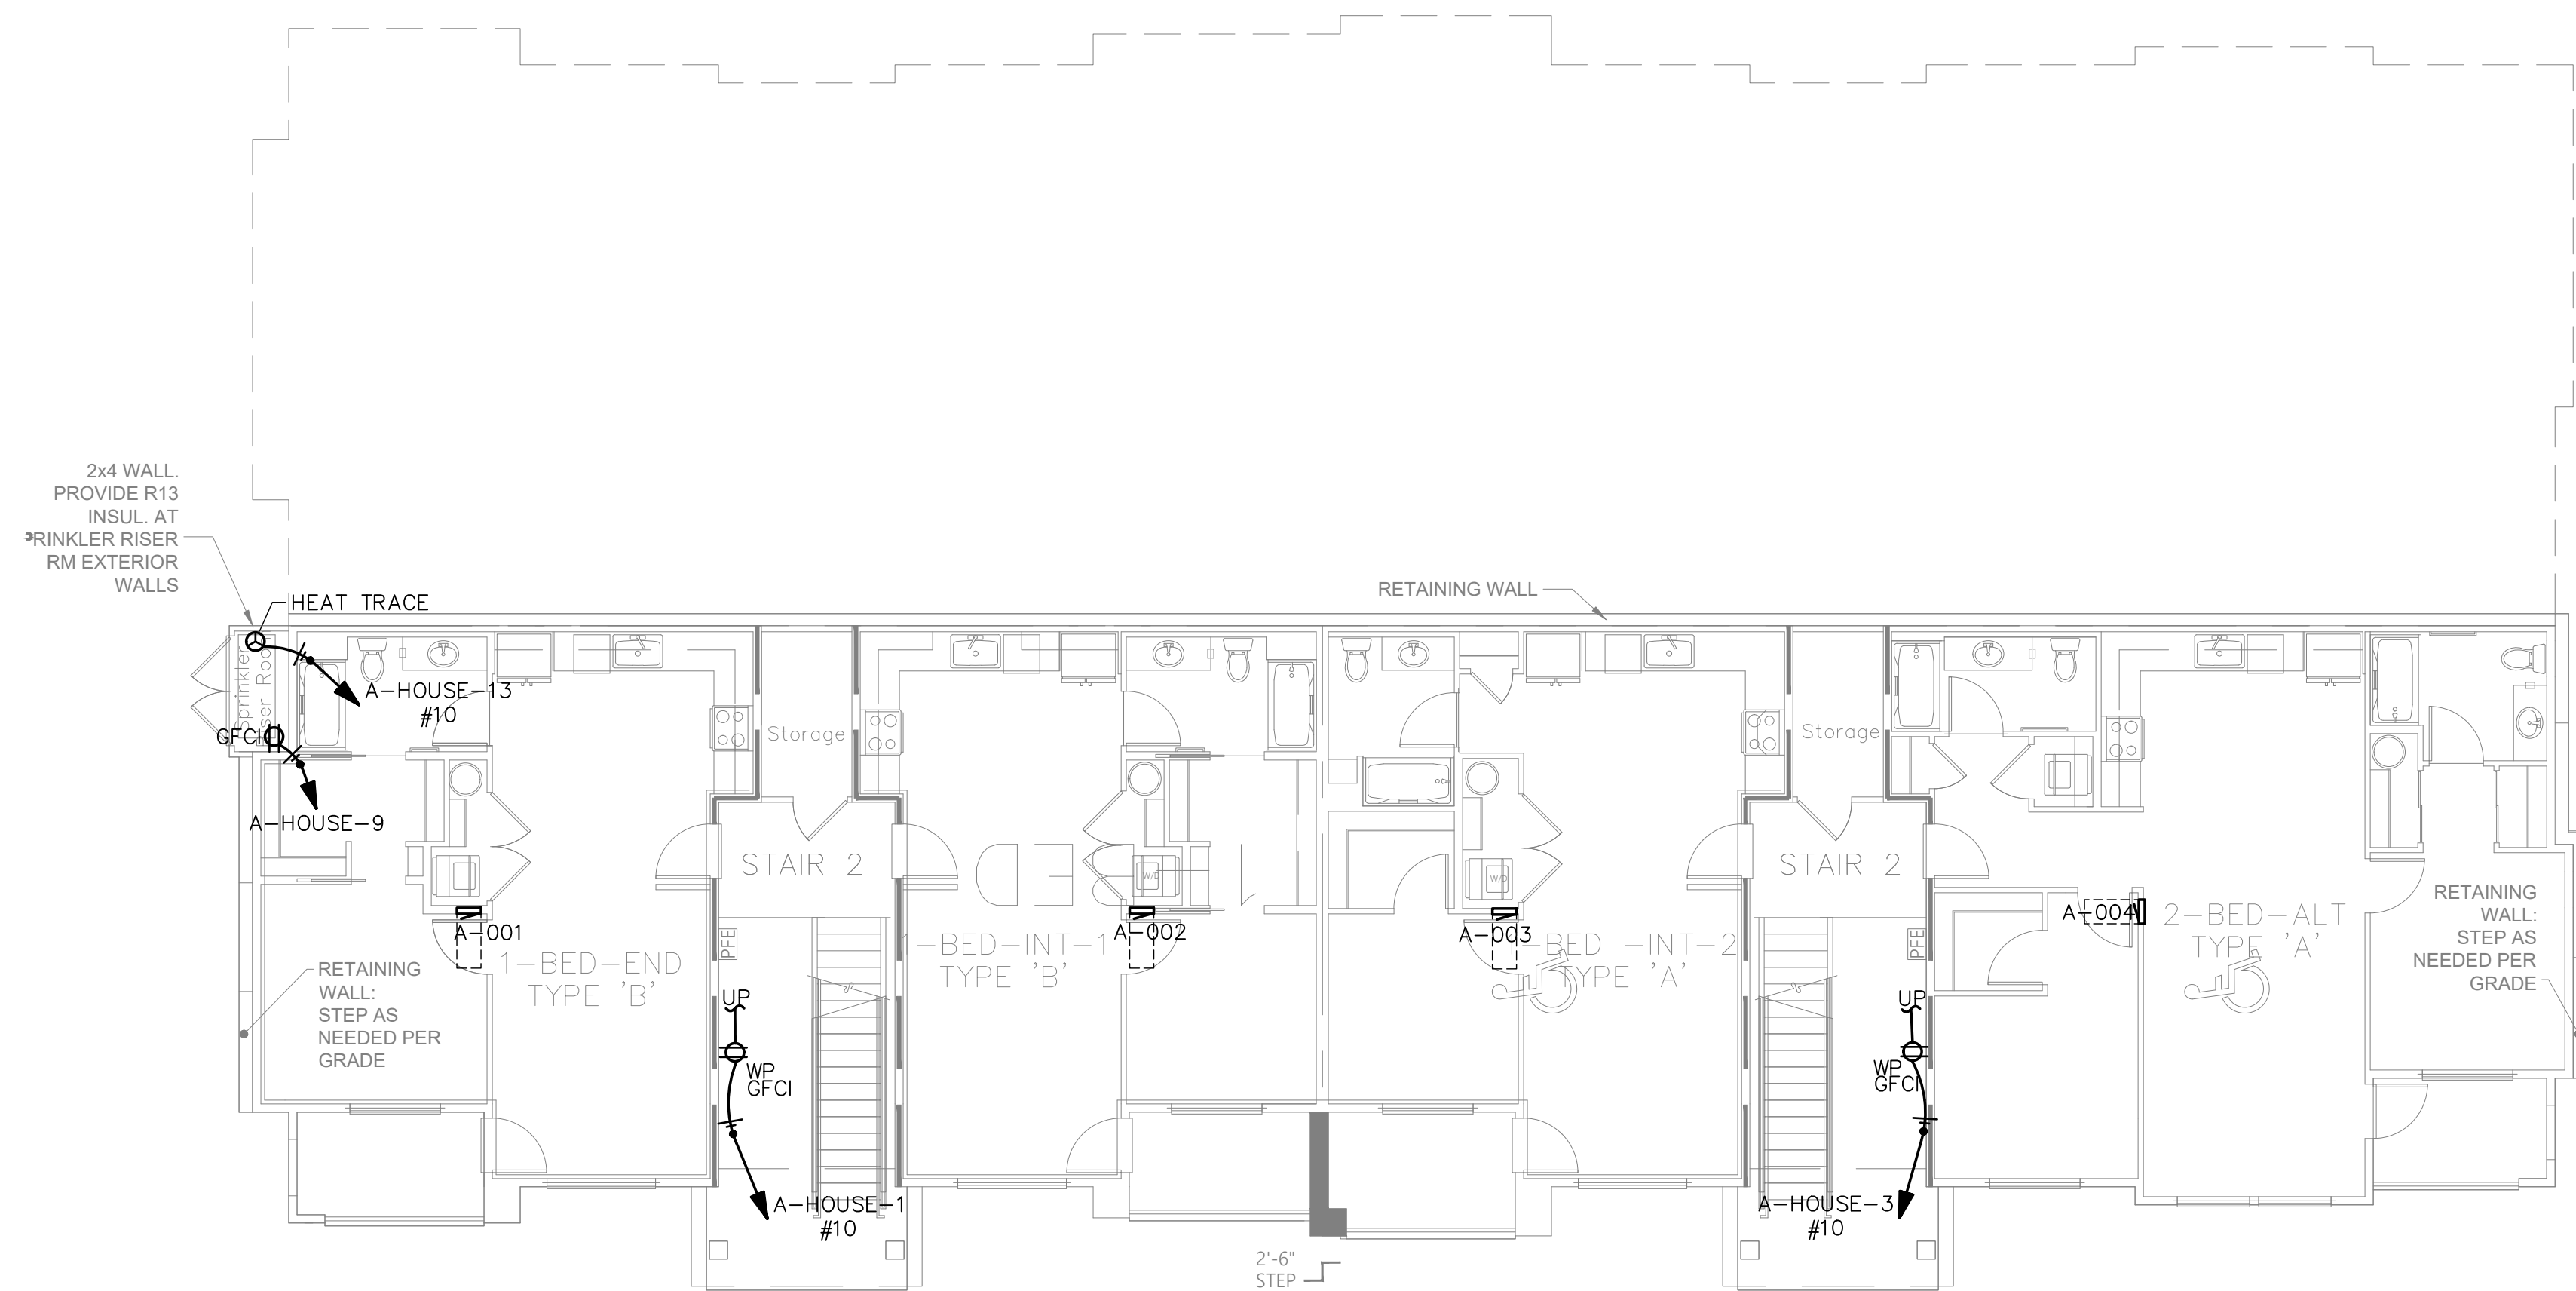

POWER PLAN - BASEMENT

SCALE: 1/8" = 1'-0"



SHEET NOTES:


1. WIRING METHOD FOR APARTMENT FEEDERS MUST BE SUITABLE FOR THE TYPE OF CONSTRUCTION. SEE NEC 334.10

FLAG NOTES:

(NOT EVERY FLAG IS USED ON EVERY SHEET)

1. FUTURE EV CHARGING STATIONS: PROVIDE 1-1/4" CONDUIT WITH PULL WIRE FROM EV PANEL(S) IN MAIN ELECTRICAL ROOM. TERMINATE CONDUIT IN A J-BOX ON WALL FOR FUTURE USE.
2. PROVIDE 2 1/2" C WITH PULL STRING WEATHER CAP TO ROOF FOR FUTURE SOLAR PATHWAY. COORDINATE RISER LOCATION WITH ARCHITECT.
3. LOCATION OF FIRE ALARM PANEL TO BE COORDINATED BY FIRE ALARM CONTRACTOR WITH FIRE AUTHORITIES.
4. SPACE FOR FUTURE SOLAR EQUIPMENT.
5. PROVIDE LEVEL ACCESS SURFACE IN FRONT OF ELECTRICAL EQUIPMENT.

NO.	DATE	DESCRIPTION	REVISIONS




DRAWN: KL	DESIGNED: MHS	CHECKED: PSR	APPROVED: JAY
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHTS APARTMENTS
 27TH AVE SE AND 5TH ST BELLEVUE, WA
 19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343
ROBISON ENGINEERING, INC.

DATE: 02/15/24



SHEET TITLE:
POWER PLAN - BASEMENT & 1ST FLOOR

SHEET NO.
E3.00

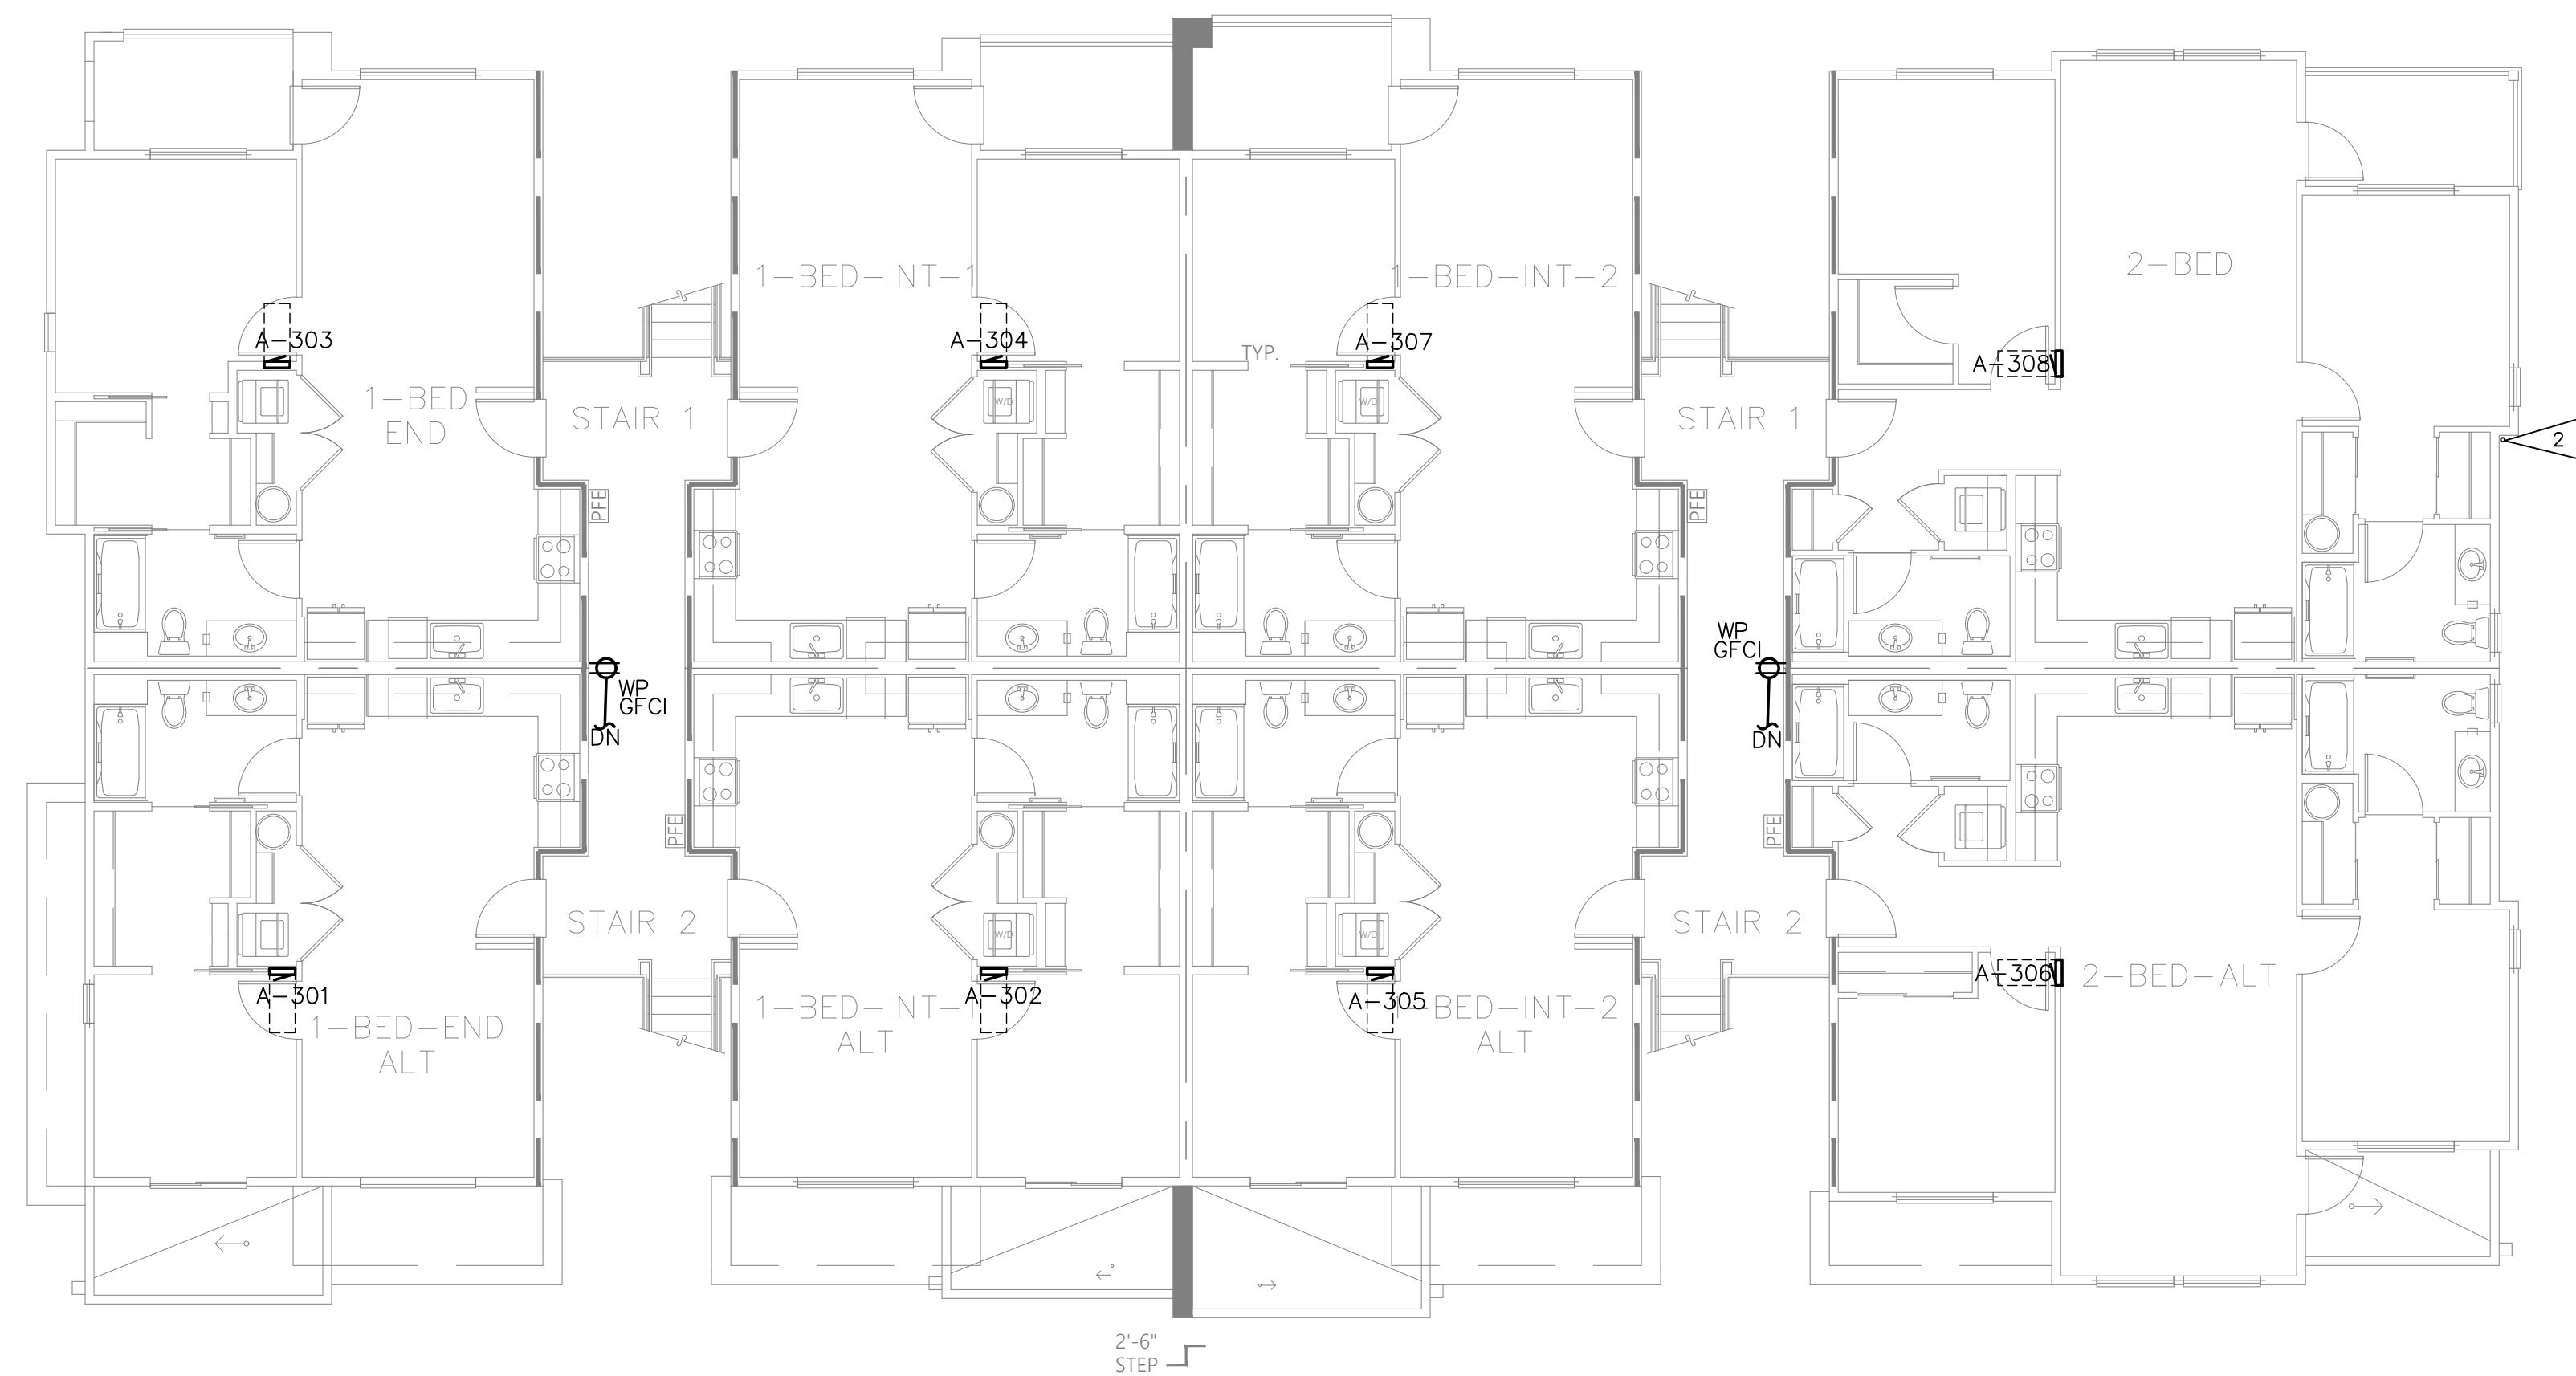


POWER PLAN – 3RD FLOOR

SCALE: 1/8" = 1'-0"

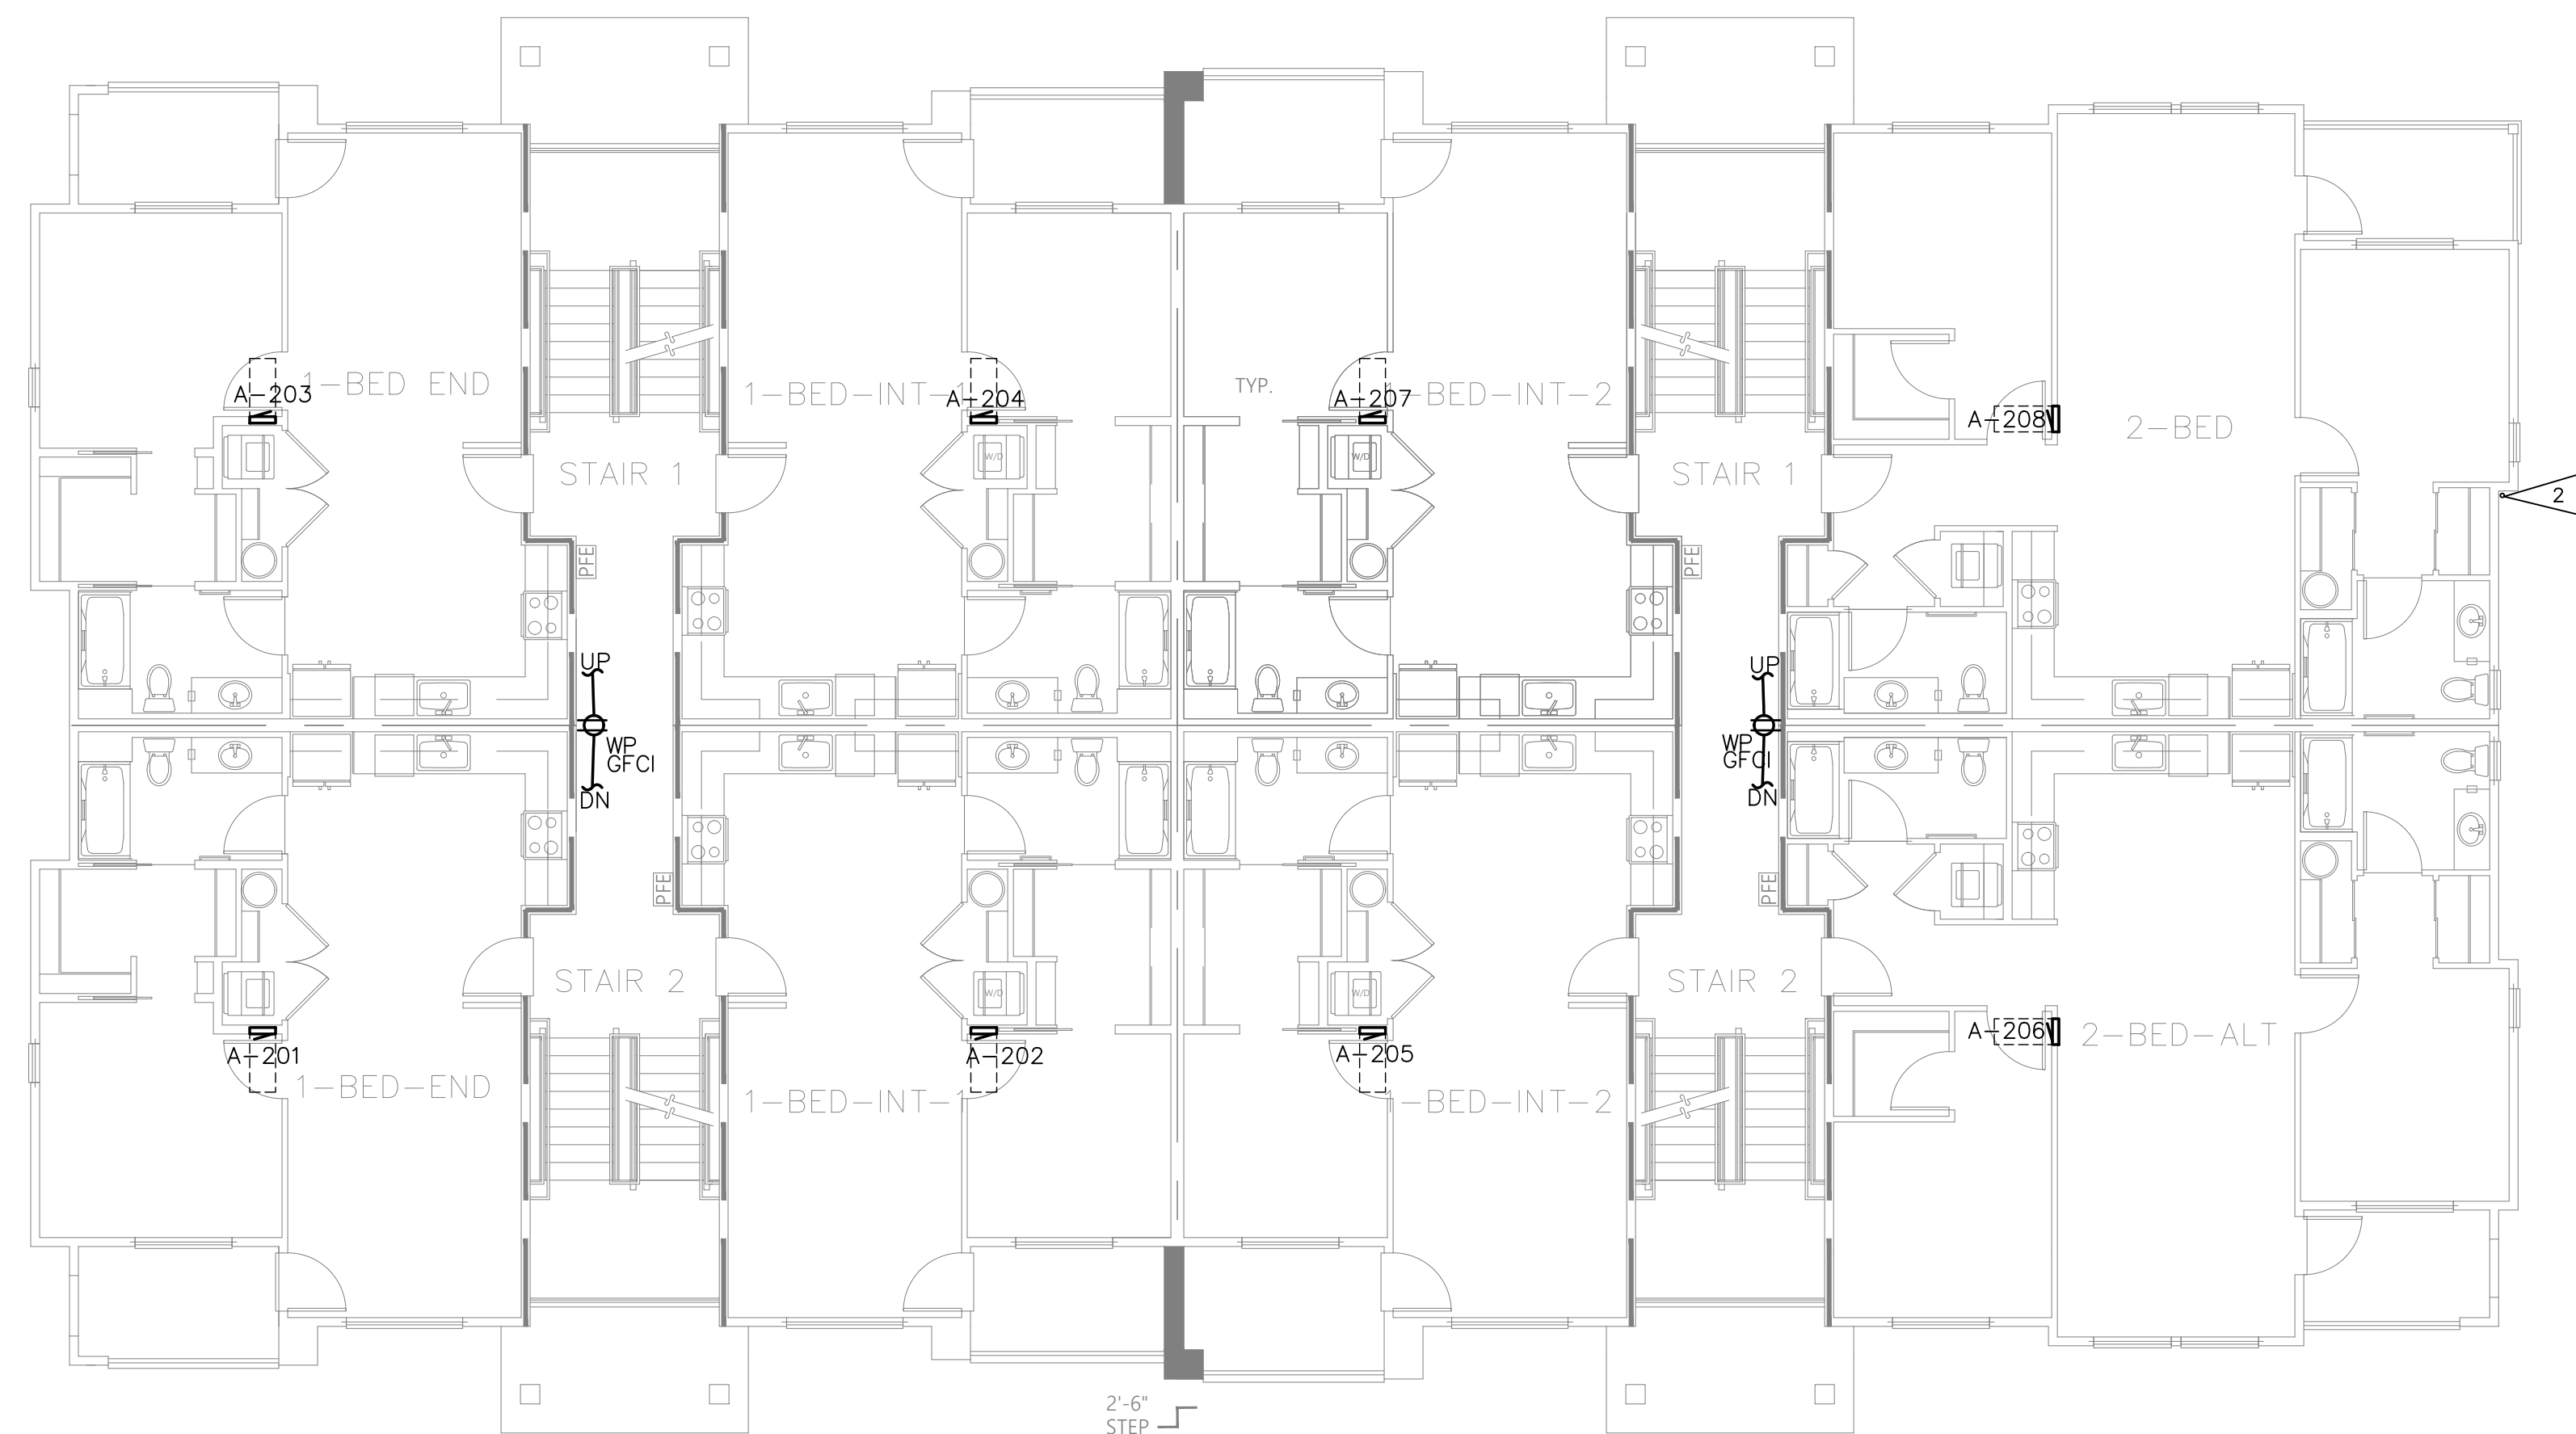

POWER PLAN – 2ND FLOOR

SCALE: 1/8" = 1'-0"




SHEET NOTES:

1. WIRING METHOD FOR APARTMENT FEEDERS MUST BE SUITABLE FOR THE TYPE OF CONSTRUCTION. SEE NEC 334.10

FLAG NOTES: (NOT EVERY FLAG IS USED ON EVERY SHEET)

1. FUTURE EV CHARGING STATIONS: PROVIDE 1-1/4" CONDUIT WITH PULL WIRE FROM EV PANEL(S) IN MAIN ELECTRICAL ROOM. TERMINATE CONDUIT IN A J-BOX ON WALL FOR FUTURE USE.
2. PROVIDE 2 1/2" C WITH PULL STRING WEATHER CAP TO ROOF FOR FUTURE SOLAR PATHWAY. COORDINATE RISER LOCATION WITH ARCHITECT.
3. LOCATION OF FIRE ALARM PANEL TO BE COORDINATED BY FIRE ALARM CONTRACTOR WITH FIRE AUTHORITIES.
4. SPACE FOR FUTURE SOLAR EQUIPMENT.
5. PROVIDE LEVEL ACCESS SURFACE IN FRONT OF ELECTRICAL EQUIPMENT.

NO.	DATE	DESCRIPTION	REVISIONS

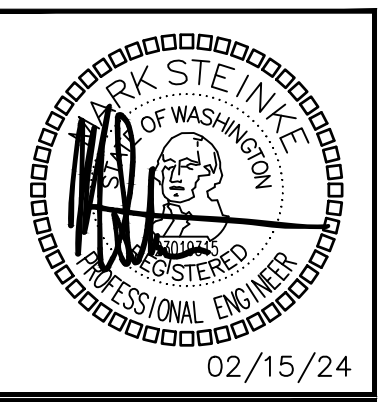

DRAWN: KL	DESIGNED: MHS	CHECKED: PSR	APPROVED: JAY
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHTS APARTMENTS
 27TH AVE SE AND 5TH ST BEIJING, WA


19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206/364-3343

ROBISON ENGINEERING, INC.

DATE: 02/15/24


SHEET TITLE:
**POWER PLAN
 - 2ND & 3RD
 FLOOR**

SHEET NO.
E3.01

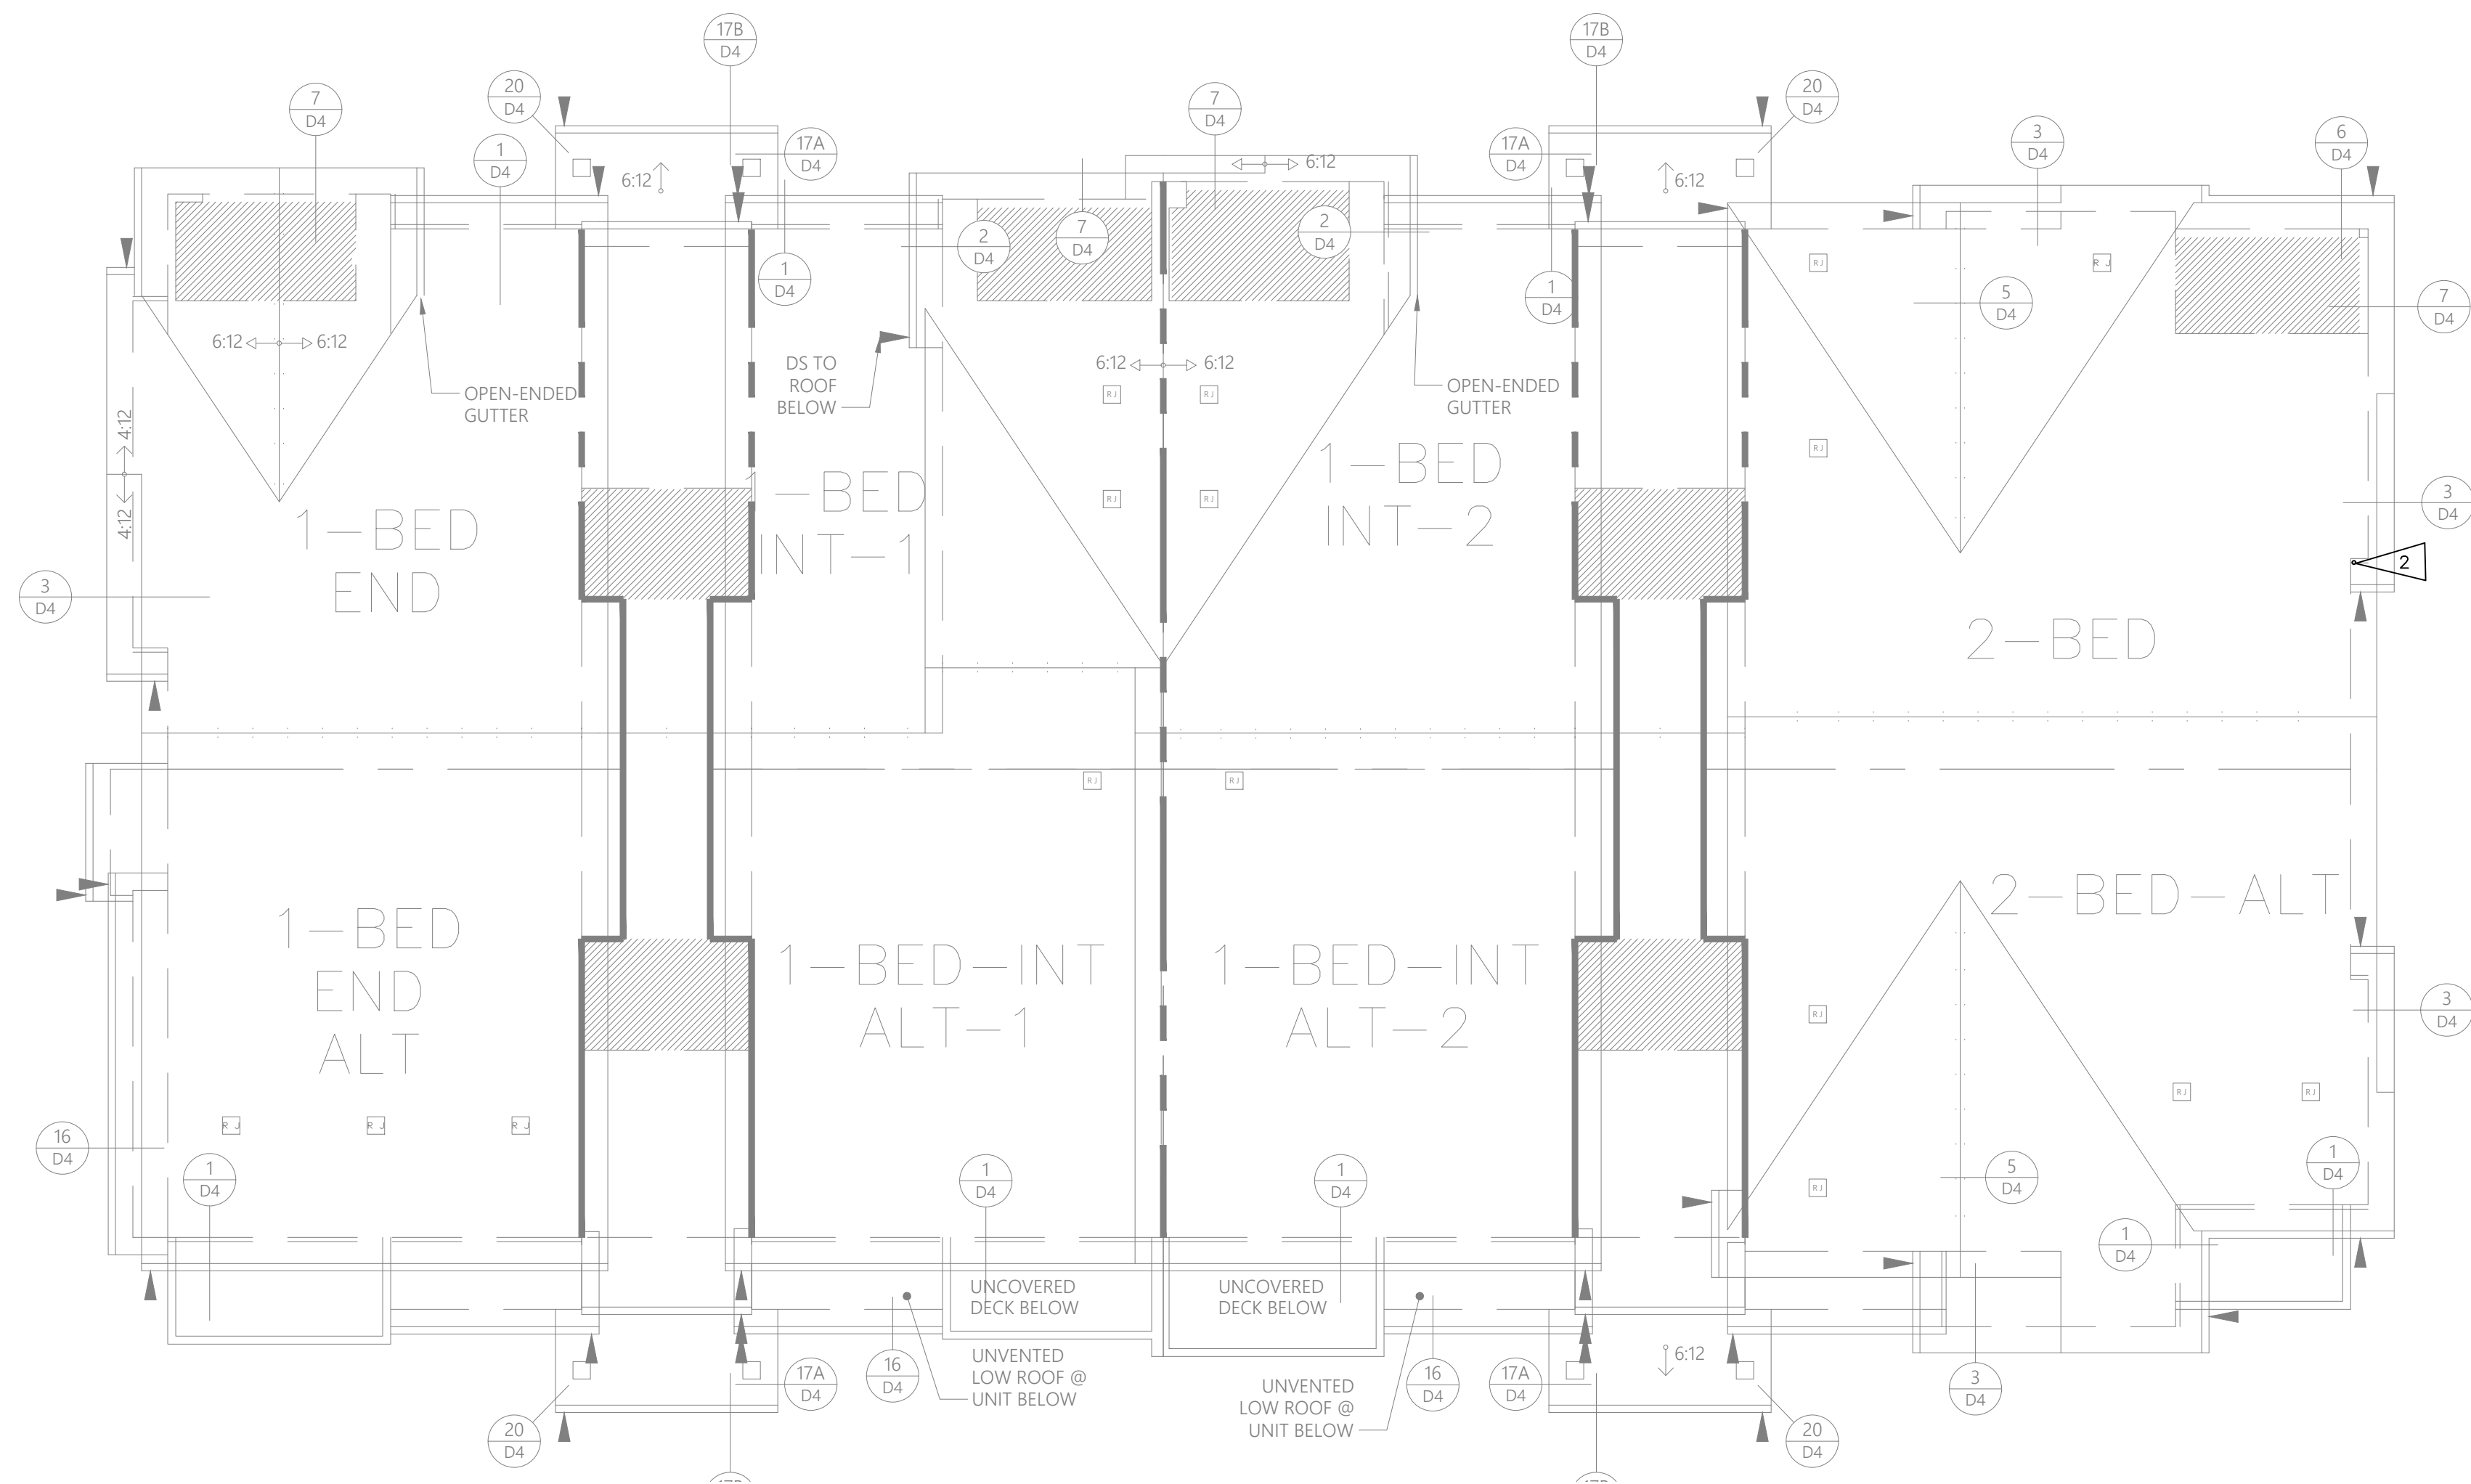

POWER PLAN – ROOF

SCALE: 1/8" = 1'-0"




SHEET NOTES:

1. WIRING METHOD FOR APARTMENT FEEDERS MUST BE SUITABLE FOR THE TYPE OF CONSTRUCTION. SEE NEC 334.10

FLAG NOTES: (NOT EVERY FLAG IS USED ON EVERY SHEET)

1. FUTURE EV CHARGING STATIONS: PROVIDE 1-1/4" CONDUIT WITH PULL WIRE FROM EV PANEL(S) IN MAIN ELECTRICAL ROOM. TERMINATE CONDUIT IN A J-BOX ON WALL FOR FUTURE USE.
2. PROVIDE 2 1/2" C WITH PULL STRING WEATHER CAP TO ROOF FOR FUTURE SOLAR PATHWAY. COORDINATE RISER LOCATION WITH ARCHITECT.
3. LOCATION OF FIRE ALARM PANEL TO BE COORDINATED BY FIRE ALARM CONTRACTOR WITH FIRE AUTHORITIES.
4. SPACE FOR FUTURE SOLAR EQUIPMENT.
5. PROVIDE LEVEL ACCESS SURFACE IN FRONT OF ELECTRICAL EQUIPMENT.

NO.	DATE	DESCRIPTION	REVISIONS



DRAWN: KL	DESIGNED: MHS	CHECKED: PSR	APPROVED: JAY
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHTS APARTMENTS
 27TH AVE SE AND 5TH ST BELLEVUE, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343

ROBISON ENGINEERING, INC

DATE: 02/15/24

SHEET TITLE:
**POWER PLAN
 - ROOF**

SHEET NO.
E3.02

UNIT LUMINAIRE SCHEDULE


CALLOUT	SYMBOL	MOUNTING	DESCRIPTION	MODEL	VOLTAGE	TYPE	LAMPING	WATTAGE	NOTES
U1	○	CEILING	4" DOWNLIGHT	DMF: DRD5S-4-R-10-9-30-0	120	0-10V DIMMING	(1) 12W LED 3000K	12	
U2	○	CEILING	4" DOWNLIGHT WET RATED	DMF: DRD5S-4-S-10-9-30-0	120	0-10V DIMMING	(1) 12W LED 3000K	12	
U3	⏏	WALL	24" VANITY LIGHT	MAXIM - 52102	120	ELV DIMMING	(1) 16W LED 3000K	16	
U4	⏏	WALL	SLIM BALCONY LIGHT	MAXIM - 26106BK	120	NON DIMMING	(1) 10W LED 3000K	10	
U5	○	SURFACE	6" FLUSH MOUNT DOWNLIGHT	MAXIM - 57413WTWT	120	0-10V DIMMING	(1) 11W LED 3000K	11	

ACCESSIBILITY NOTES:

- ALL SWITCHES AND CONTROLS - 15" MIN; 48" MAX TO CONTROL.
- GENERAL OUTLETS MIN 18" AFF.
- ALL SWITCHES/CONTROLS ABOVE COUNTERTOPS 48" MAX.
- ELECTRICAL SUB-PANELS IN UNITS MUST COMPLY WITH ABOVE REACH RANGES.
- SWITCHES FOR EXHAUST HOODS AND GARBAGE DISPOSALS MUST COMPLY WITH ABOVE REACH RANGES. INSTALL SWITCHES ON FACE OF CABINETS IF REQUIRED TO COMPLY.

APARTMENT NOTES:

- ALL ELECTRICAL WORK SHALL COMPLY WITH ALL LOCAL AND NATIONAL CODES.
- DEVICE BOXES ON OPPOSITE SIDES OF DEMISING WALLS SHALL BE IN SEPARATE STUD BAYS. PROVIDE BACKING EQUIVALENT TO LOWRY'S OUTLET BOX PADS. CONDUIT FROM ONE UNIT SHALL NOT PASS THROUGH STUDS OF A SHARED WALL(DOUBLE STUDS) FROM AN ADJACENT UNIT(BRIDGING).
- PROVIDE ARC-FAULT PROTECTION, TAMPER PROOF AND GFCI RECEPTACLES AS REQUIRED BY CODE AND LOCAL AHJ. ARC-FAULT PROTECTION MUST BE PROVIDED FOR CIRCUITS IN THE AREAS LISTED IN NEC 210.12(A).
- PROVIDE SUFFICIENT DUPLEX RECEPTACLES TO MEET NEC 210.52.
- THERMOSTATS SHALL NOT INTERFERE WITH DOOR SWINGS.
- ELECTRICAL CONTRACTOR SHALL MAKE ALL FINAL CONNECTIONS FOR KITCHEN APPLIANCES. COORDINATE ALL J-BOX LOCATIONS WITH APPLIANCE INSTALLATION INSTRUCTIONS PRIOR TO ROUGH-IN.
- ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL CORD AND PLUG ASSEMBLY FOR EACH DISPOSER.
- PROVIDE A DEDICATED 20 AMP CIRCUIT TO EACH UNIT BATHROOM RECEPTACLE. BATHROOM LIGHTS, FAN TO BE ON SAME CIRCUIT PER 210.11(C)(3) EXCEPTION.
- HOME RUNS AND LOOPS CONNECTING LIGHT FIXTURES, WIRING DEVICES, AND HVAC EQUIPMENT ON PLANS INDICATE CIRCUITING SCHEME. SEE TYPICAL PANEL SCHEDULES FOR ACTUAL CIRCUIT NUMBERS FOR TYPICAL APARTMENT.
- LIGHTS WITHIN 3' HORIZONTAL OF SHOWER OR TUB TO BE WET LOCATION RATED AND HAVE FULLY ENCLOSED TRIMS. PROVIDE GFCI PROTECTION IF THE LUMINAIRE INSTALLATION MANUAL STATES IT IS REQUIRED.
- PROVIDE SMOKE DETECTORS AND CO ALARMS AS REQUIRED. DETECTORS AND ALARMS TO BE HARDWIRED AND PROVIDED WITH BATTERY BACKUP.
- ELECTRICAL CONTRACTOR SHALL INSTALL RECEPTACLES AND TV, DATA/PHONE OUTLETS UNDER COMMON COVER PLATE WHERE POSSIBLE. PROVIDE AND INSTALL DIVIDERS AS REQUIRED FOR CABLE/POWER SEPARATION.
- SEE ARCHITECTURAL DRAWINGS FOR DIMENSIONS AND LAYOUTS OF ALL DEVICES.
- ALL WALL PENETRATIONS SHALL BE CAULKED WITH APPROVED MATERIAL TO MAINTAIN THE FIRE RATING OF ALL WALLS AND FLOORS.
- ALL CONDUIT SHALL BE INSTALLED IN NEAT SYMMETRICAL LINES HORIZONTAL OR PERPENDICULAR TO BUILDING COLUMNS AND ROOF LINES. CONDUITS SHALL BE GROUPED ON COMMON SUPPORTS WHEREVER POSSIBLE.
- REFERENCE MECHANICAL DRAWINGS FOR EXACT LOCATION OF ALL MECHANICAL EQUIPMENT.
- ELECTRICAL CONTRACTOR SHALL VERIFY ALL FUSE RATING WIRE SIZES AND DISCONNECT SIZES WITH EQUIPMENT SERVED ON THE JOB PRIOR TO INSTALLATION.
- SEE ARCHITECTURAL DRAWINGS AND ELEVATIONS FOR ADDITIONAL DETAILS AND CASEWORK DIMENSIONS.
- DEVICE LOCATIONS IN 1ST DWELLING/RESIDENT UNIT SHALL BE REVIEWED AND APPROVED BY OWNER PRIOR TO ROUGH-IN OF REMAINING UNITS
- CONFIRM FINAL LOCATION OF HEATERS AND THERMOSTATS IN FIELD PRIOR TO ROUGH-IN

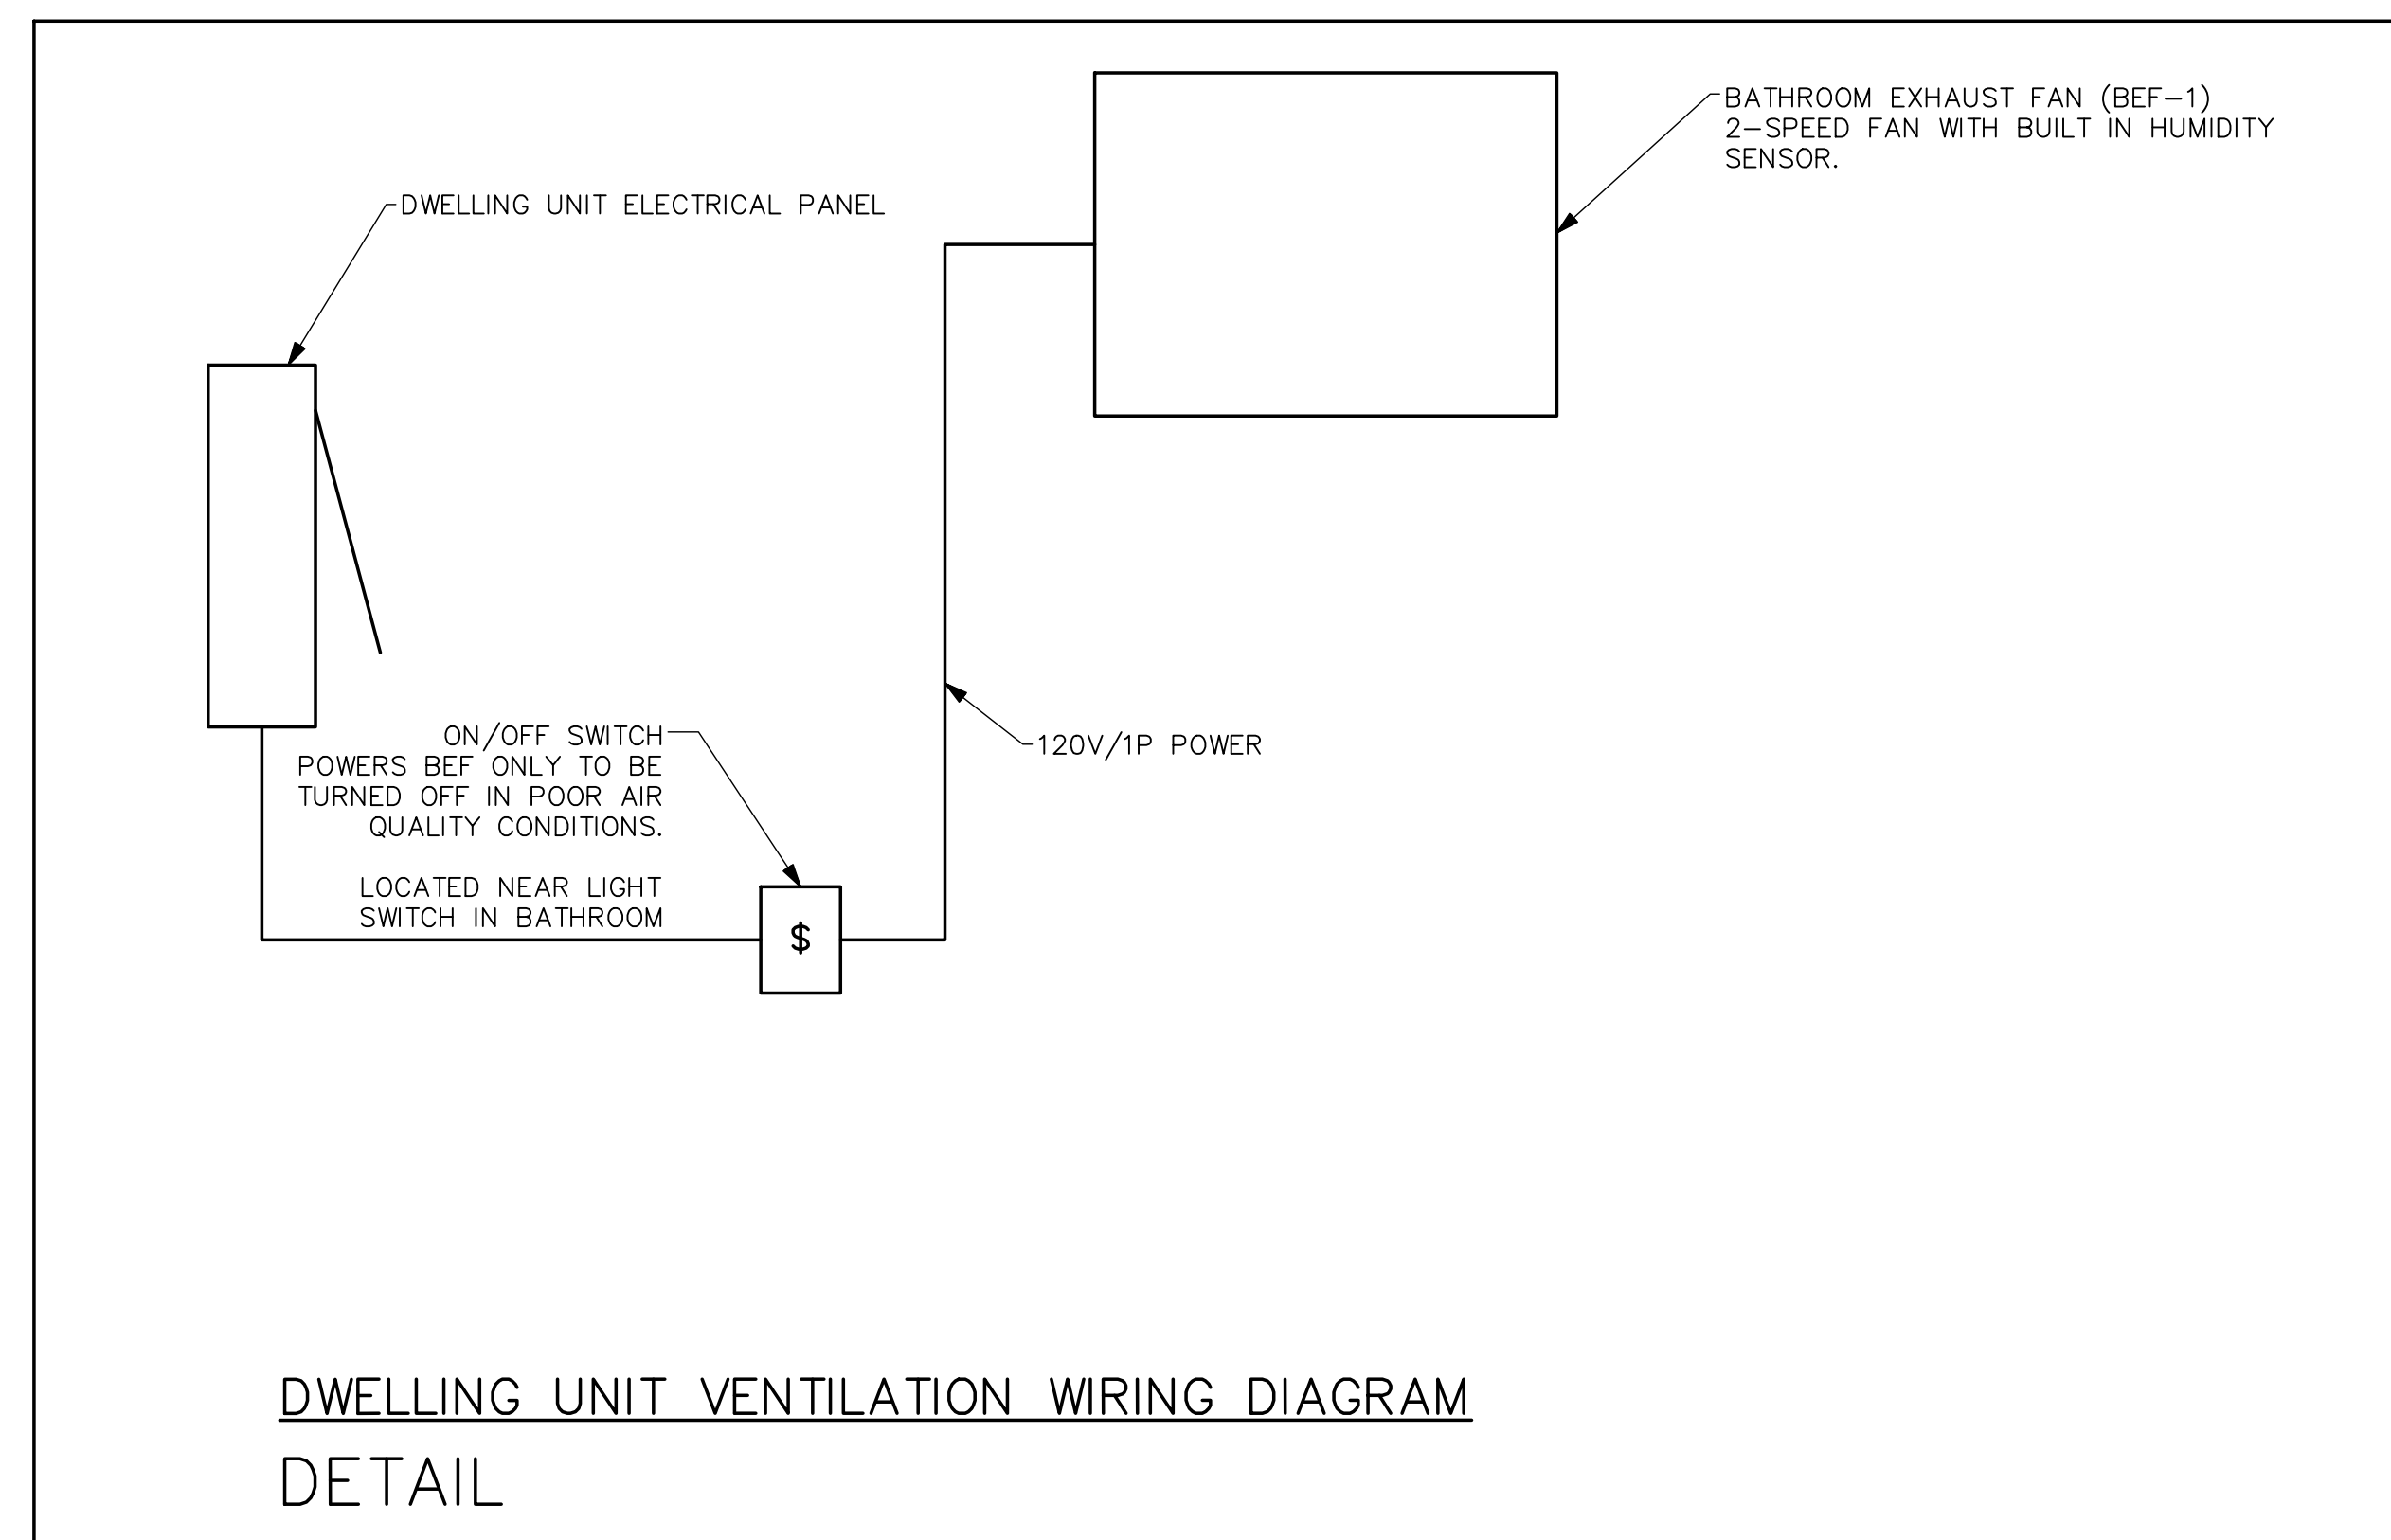


DWELLING UNIT VENTILATION WIRING DIAGRAM DETAIL

ELECTRIC HEATERS					
EQUIP NO.	SERVICE	MOUNTING/DISCHARGE	HEATING	ELECTRICAL	BASIS OF DESIGN
			KW	VOLTAGE	
EWH-1	BEDROOM	WALL	1	208V/1P	(1)
EWH-2	LIVING ROOM	WALL	1.5	208V/1P	(1)

- NOTES:
- (1) BROAN, CADET OR EQUIVALENT.
 - (2) PROVIDE REMOTE THERMOSTAT.

NO.	DATE	DESCRIPTION	REVISIONS

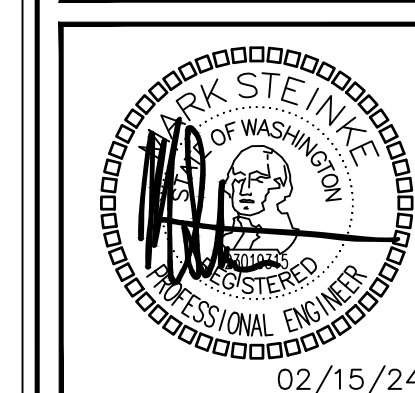

DRAWN: KL	DESIGNED: MHS	CHECKED: PSR	APPROVED: JAY
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHTS APARTMENTS
 27TH AVE SE AND 5TH ST BELLEVUE, WA


19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343

ROBISON ENGINEERING, INC

DATE: 02/15/24

SHEET TITLE:
UNIT PLANS NOTES


SHEET NO.
E5.00

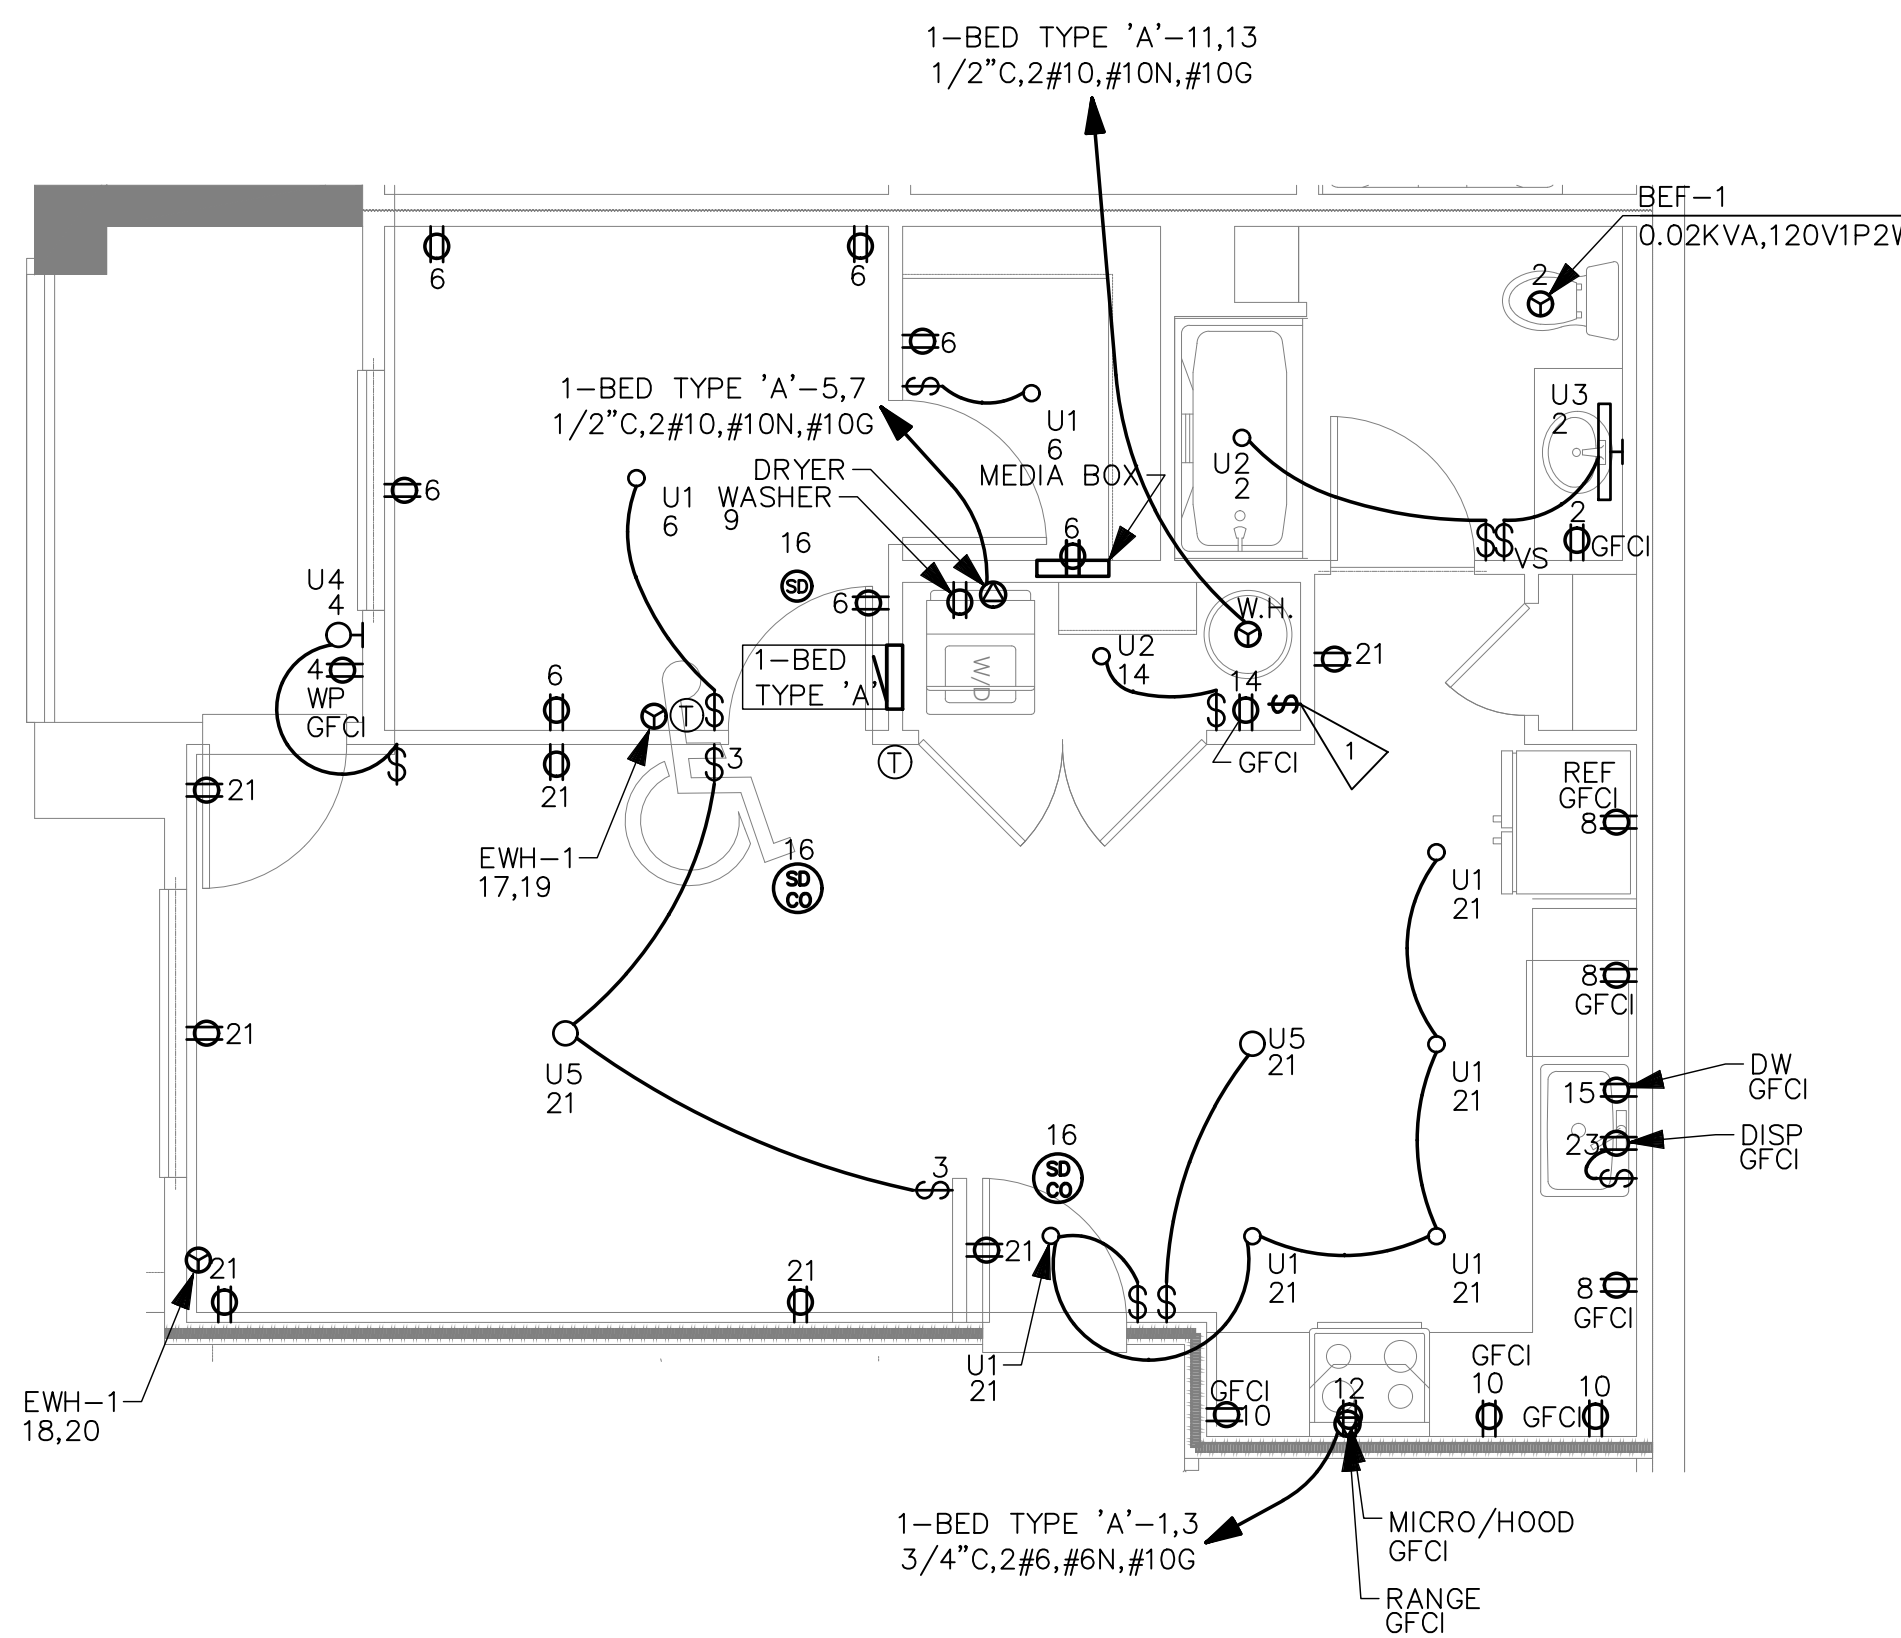

UNIT TYPICALS

1-BED-INT-2 TYPE 'A'

SCALE: 1/4" = 1'-0"

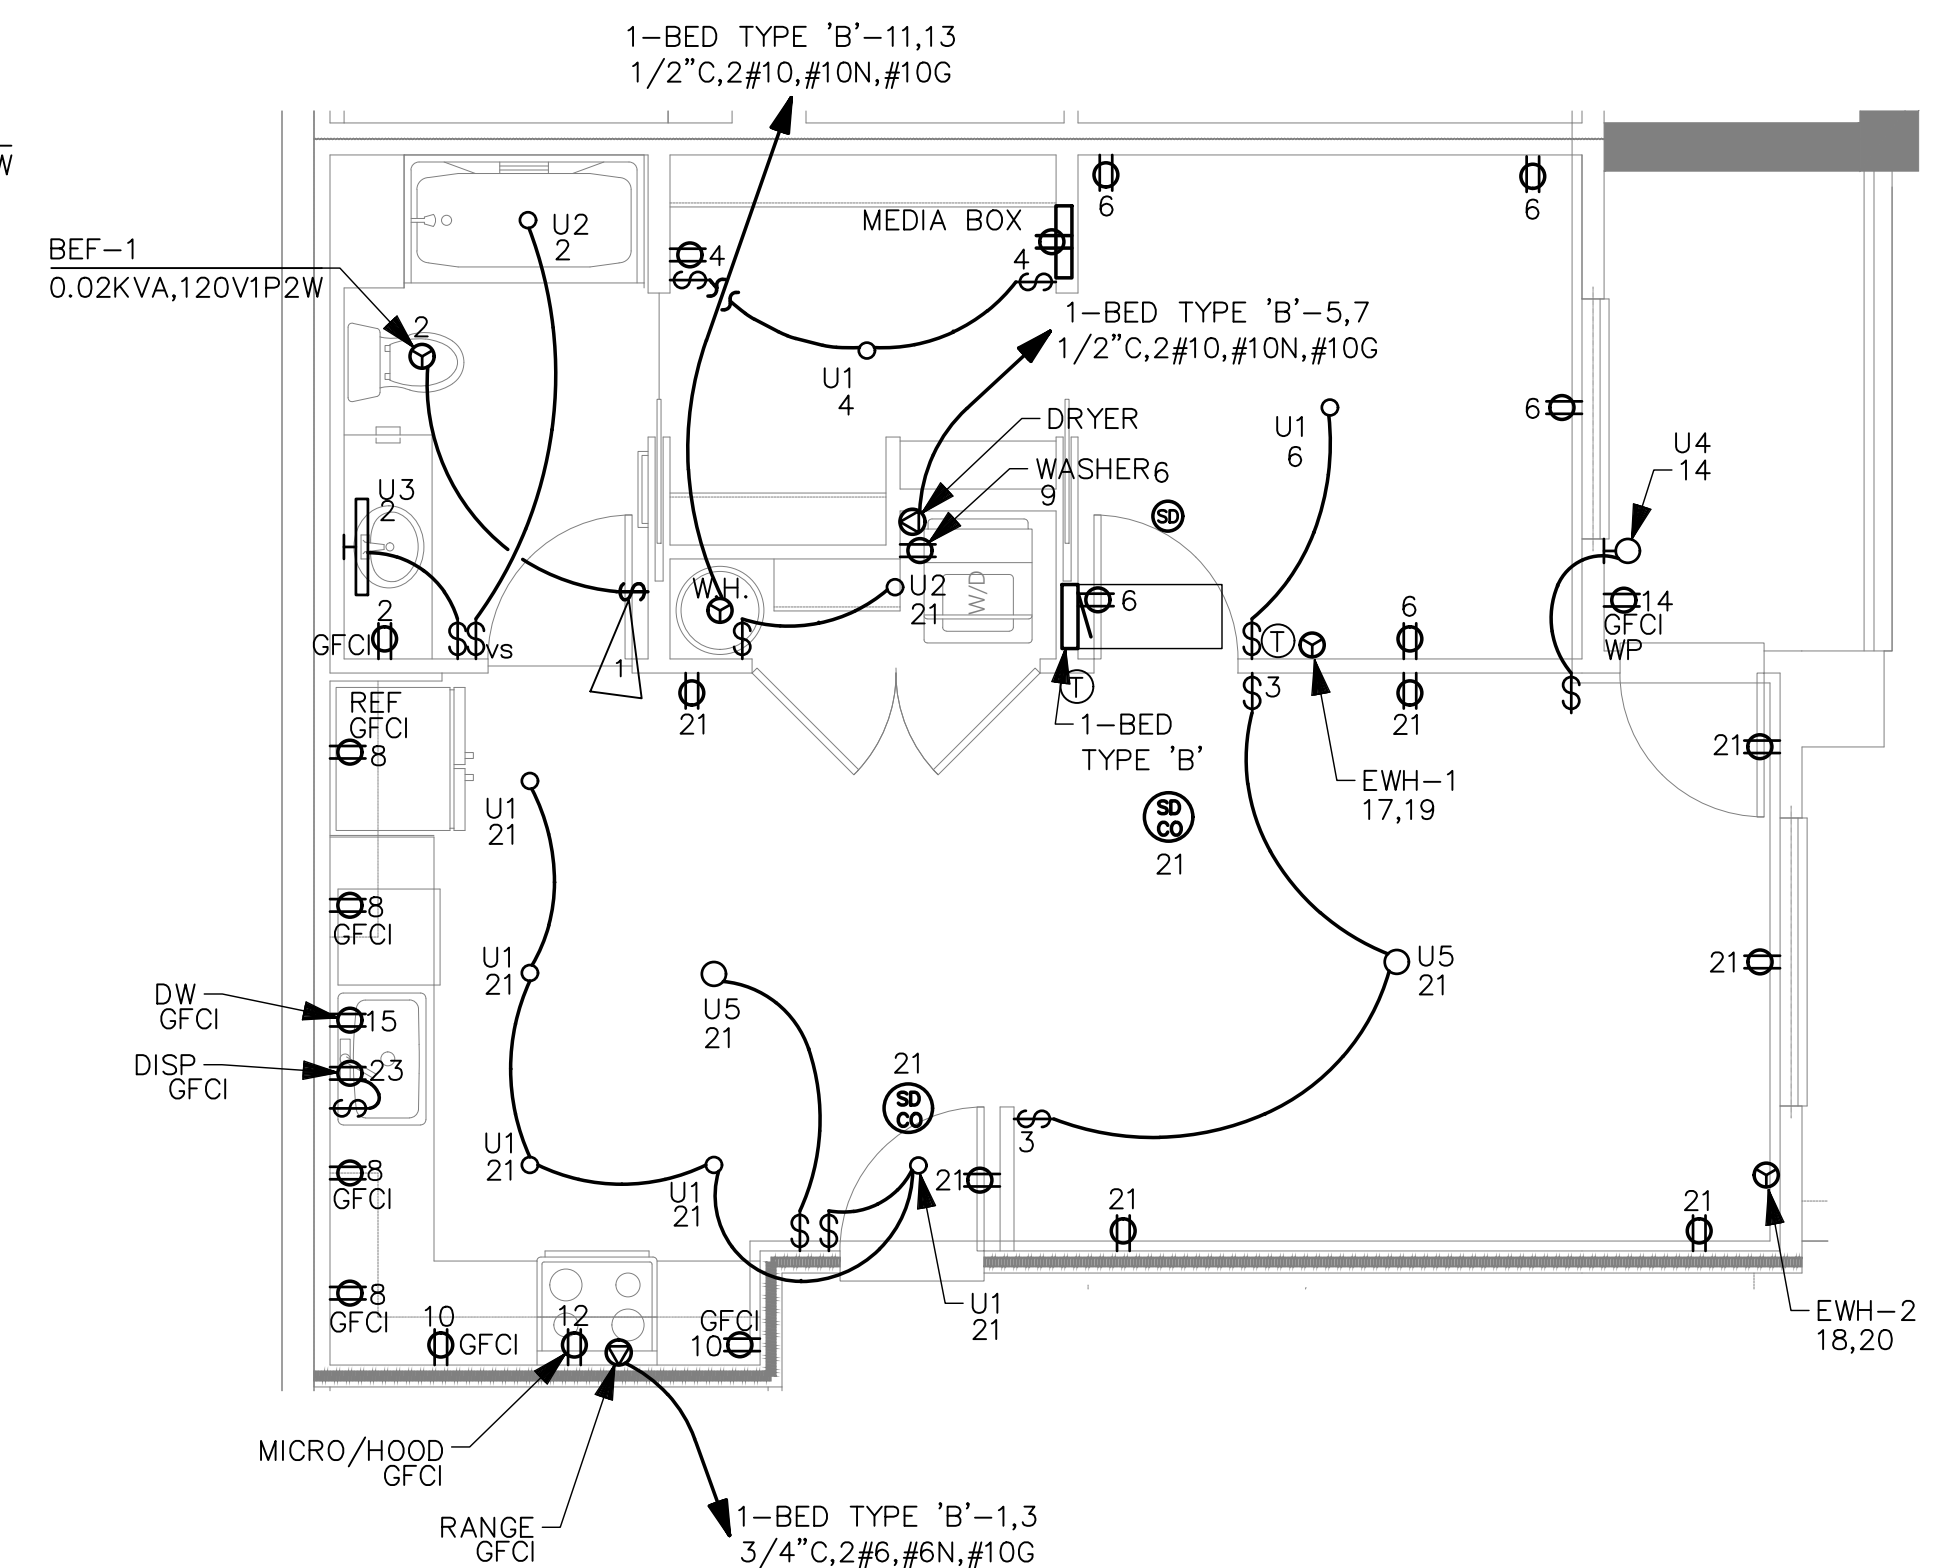

UNIT TYPICALS

1-BED-INT-1 TYPE 'B'

SCALE: 1/4" = 1'-0"

Panel		ROOM	VOLTS	208/120V 2P 3W	AIC	22,000	
1-BED TYPE 'A'		FLUSH 'A'	BUS AMPS 125		MAIN BKR	MLO	
		FED FROM	NEUTRAL 100%		LUGS	STANDARD	
NOTE							
CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION	CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION
1	50/2	8	RANGE	a 2	20/1	0.23	ERV, LIGHTING, RECEPTACLE
3				b 4	20/1	0.19	LIGHTING, RECEPTACLE
5	30/2	4.99	DRYER	a 6	20/1	1.28	LIGHTING, MEDIA BOX, RECEPTACLE
7				b 8	20/1	1.5	SMALL APPLIANCE
9	20/1	1.5	WASHER	a 10	20/1	1.5	SMALL APPLIANCE
11	30/2	4.4	WATER HEATER	b 12	20/1	1.58	MICRO/HOOD
13				a 14	20/1	0.192	LIGHTING, RECEPTACLE
15	20/1	1.2	DISHWASHER	b 16	20/1	0.15	SDCO
17	20/2	0.75	WALL HEATER	a 18	20/1	0	SPARE
19				b 20	20/1	0	SPARE
21	20/1	1.34	LIGHTING, RECEPTACLE	a 22	20/1	0	SPARE
23	20/1	0.7	DISPOSAL	b 24	20/1	0	SPARE

OPTIONAL DWELLING UNIT CALCULATION (NEC 220.82)					
	CONN KVA		CONN KVA	CALC KVA	
LIGHTING AND RECEPTACLES	2.61	871 SF (3 VA/SF)	GENERAL LOAD UP TO 10 KVA	10	10 (100%)
SMALL-APPLIANCE	3		OVER 10 KVA	13.6	5.43 (40%)
LAUNDRY	1.5		MAX HEATING OR COOLING	3.35	(220.82(C)(4))
APPLIANCES	8.47		TOTAL LOAD	18.8	
ELECTRIC COOKING	8		BALANCED LOAD	90.3 A	
TOTAL GENERAL LOAD	23.6		PHASE A	102%	
			PHASE B	97.8%	

Panel		ROOM	VOLTS	208/120V 2P 3W	AIC	22,000	
1-BED TYPE 'B'		FLUSH 'B'	BUS AMPS 125		MAIN BKR	MLO	
		FED FROM	NEUTRAL 100%		LUGS	STANDARD	
NOTE							
CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION	CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION
1	50/2	8	RANGE	a 2	20/1	0.23	ERV, LIGHTING, RECEPTACLE
3				b 4	20/1	0.372	LIGHTING, MEDIA BOX, RECEPTACLE
5	30/2	4.99	DRYER	a 6	20/1	0.912	LIGHTING, RECEPTACLE
7				b 8	20/1	1.5	SMALL APPLIANCE
9	20/1	1.5	WASHER	a 10	20/1	1.5	SMALL APPLIANCE
11	30/2	4.4	WATER HEATER	b 12	20/1	1.58	MICRO/HOOD
13				a 14	20/1	0.19	LIGHTING, RECEPTACLE
15	20/1	1.2	DISHWASHER	b 16	20/1	0.53	RECEPTACLE, SDCO
17	20/2	0.75	WALL HEATER	a 18	20/1	0	SPARE
19				b 20	20/1	0	SPARE
21	20/1	1.35	LIGHTING, RECEPTACLE	a 22	20/1	0	SPARE
23	20/1	0.7	DISPOSAL	b 24	20/1	0	SPARE

OPTIONAL DWELLING UNIT CALCULATION (NEC 220.82)					
	CONN KVA		CONN KVA	CALC KVA	
LIGHTING AND RECEPTACLES	2.61	871 SF (3 VA/SF)	GENERAL LOAD UP TO 10 KVA	10	10 (100%)
SMALL-APPLIANCE	3		OVER 10 KVA	13.6	5.43 (40%)
LAUNDRY	1.5		MAX HEATING OR COOLING	3.35	(220.82(C)(4))
APPLIANCES	8.47		TOTAL LOAD	18.8	
ELECTRIC COOKING	8		BALANCED LOAD	90.3 A	
TOTAL GENERAL LOAD	23.6		PHASE A	99.4%	
			PHASE B	101%	

GENERAL NOTES:

- COORDINATE FINAL LOCATION OF THERMOSTATS, SWITCHES, RECEPTACLES, DATA, PHONE, LIGHT FIXTURES AND J-BOXES WITH ARCHITECTURAL ELEVATIONS AND INTERIOR DESIGN PLANS PRIOR TO ROUGH-IN.
- ADA UNITS SHALL HAVE HOOD CONTROLS INSTALLED IN THE FACE OF THE LOWER CABINET WORK.
- PROVIDE TAMPER RESISTANT RECEPTACLES PER NEC 406.12.
- ALL UNITS: PROVIDE SWITCH CONTROLLING GARBAGE DISPOSAL TO BE LOCATED ABOVE BACKSPLASH NEXT TO SINK OR ON COUNTER. SEE ARCHITECTURE.
- BATHROOM GFCI RECEPTACLES TO HAVE INTEGRAL NIGHTLIGHT.
- RECESSED CEILING LIGHT IN BATHROOM SHALL BE LED RATED FOR WET LOCATIONS W/ SHATTER PROOF LENS.
- ALL RECEPTACLES SHALL MEET REQUIREMENTS OF NEC ARTICLE 210.
- PROVIDE TELEPHONE & CABLE T.V. MEDIA TERMINATION ENCLOSURE (MEDIA BOX): PROVIDE LEVITON COMPACT MEDIA ENCLOSURE OR EQUIVALENT IN WALL WITH TOP NO HIGHTER THAN 60" AFF WITH 120V RECEPTACLE ADJACENT.
- PROVIDE COMBINATION HARDWIRED 120VAC PHOTOELECTRIC SMOKE DETECTOR AND CARBON MONOXIDE DETECTOR WITH BATTERY-BACKUP
 - DETECTOR SHALL BE MINIMUM 6' HORIZONTAL DISTANCE FROM PERMANENT COOKING APPLIANCE PER CFC 90.2.11.8.
 - DETECTOR SHALL BE MINIMUM 3' HORIZONTAL DISTANCE FROM THE DOOR OF A BATHROOM THAT CONTAINS A BATHTUB OR SHOWER PER CFC 90.2.11.8.
 - PROVIDE INTERCONNECTION WIRING SUCH THAT ACTUATION OF ONE ALARM WILL ACTIVATE ALL ALARMS IN THE DWELLING UNIT.
 - COORDINATE WITH AHJ ON INTERCONNECTING EACH DWELLING UNIT INTO THE FIRE ALARM SYSTEM FOR THE BUILDING.
 - COORDINATE WITH AHJ AS TO THE NUMBER AND LOCATION OF DEVICES PRIOR TO ROUGH-IN. DEVICES SHOWN ARE DIAGRAMMATIC.
- DISHWASHER OUTLET SHALL BE ACCESSIBLE. RECEPTACLE SHALL BE LOCATED IN SPACE ADJACENT TO THE DISHWASHER.
- PROVIDE 7-DAY PROGRAMMABLE THERMOSTAT FOR THE LIVING ROOM.


FLAG NOTES

- INTERLOCK ERV/BEF TO ON/OFF SWITCH. PROVIDE PERMANENT LABEL SAYING, "WHOLE HOUSE VENTILATION. LEAVE ON UNLESS OUTDOOR AIR QUALITY IS VERY POOR." ADHERE PERMANENT LABEL TO WALL ABOVE WALL SWITCH.

AFCI/GFCI REQUIREMENTS FOR DWELLING UNITS:

- ALL 15 AND 20A, 120V SINGLE PHASE CIRCUITS NOT INCLUDING THE BATHROOM SHALL BE AFCI PROTECTED (210.12).
- ALL DWELLING UNIT CIRCUITS IN BATHROOMS, GARAGES, OUTDOORS, KITCHENS, LAUNDRY AREAS, AND AREAS WITHIN 6' OF A SINK SHALL BE GFCI PROTECTED (210.8).
 - BATHROOM CIRCUIT TO BE GFCI PROTECTED VIA A GFCI RECEPTACLE, WHILE OTHER CIRCUITS SHALL BE PROTECTED AT THE BREAKER.
- UTILIZE "DUAL FUNCTION" BREAKER WHEN BOTH AFCI AND GFCI PROTECTION IS REQUIRED.

NO.	DATE	DESCRIPTION	REVISIONS

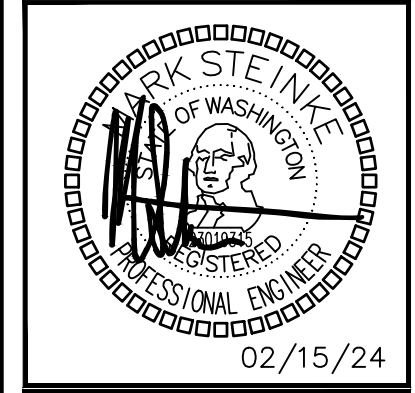

DRAWN: KL	DESIGNED: MHS	CHECKED: PSR	APPROVED: JAY
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHTS APARTMENTS
27TH AVE SE AND 5TH ST BELLEVUE, WA


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 364-3343

ROBISON ENGINEERING, INC.

DATE: 02/15/24

SHEET TITLE:
UNIT PLANS & SCHEDULES

SHEET NO.
E5.01

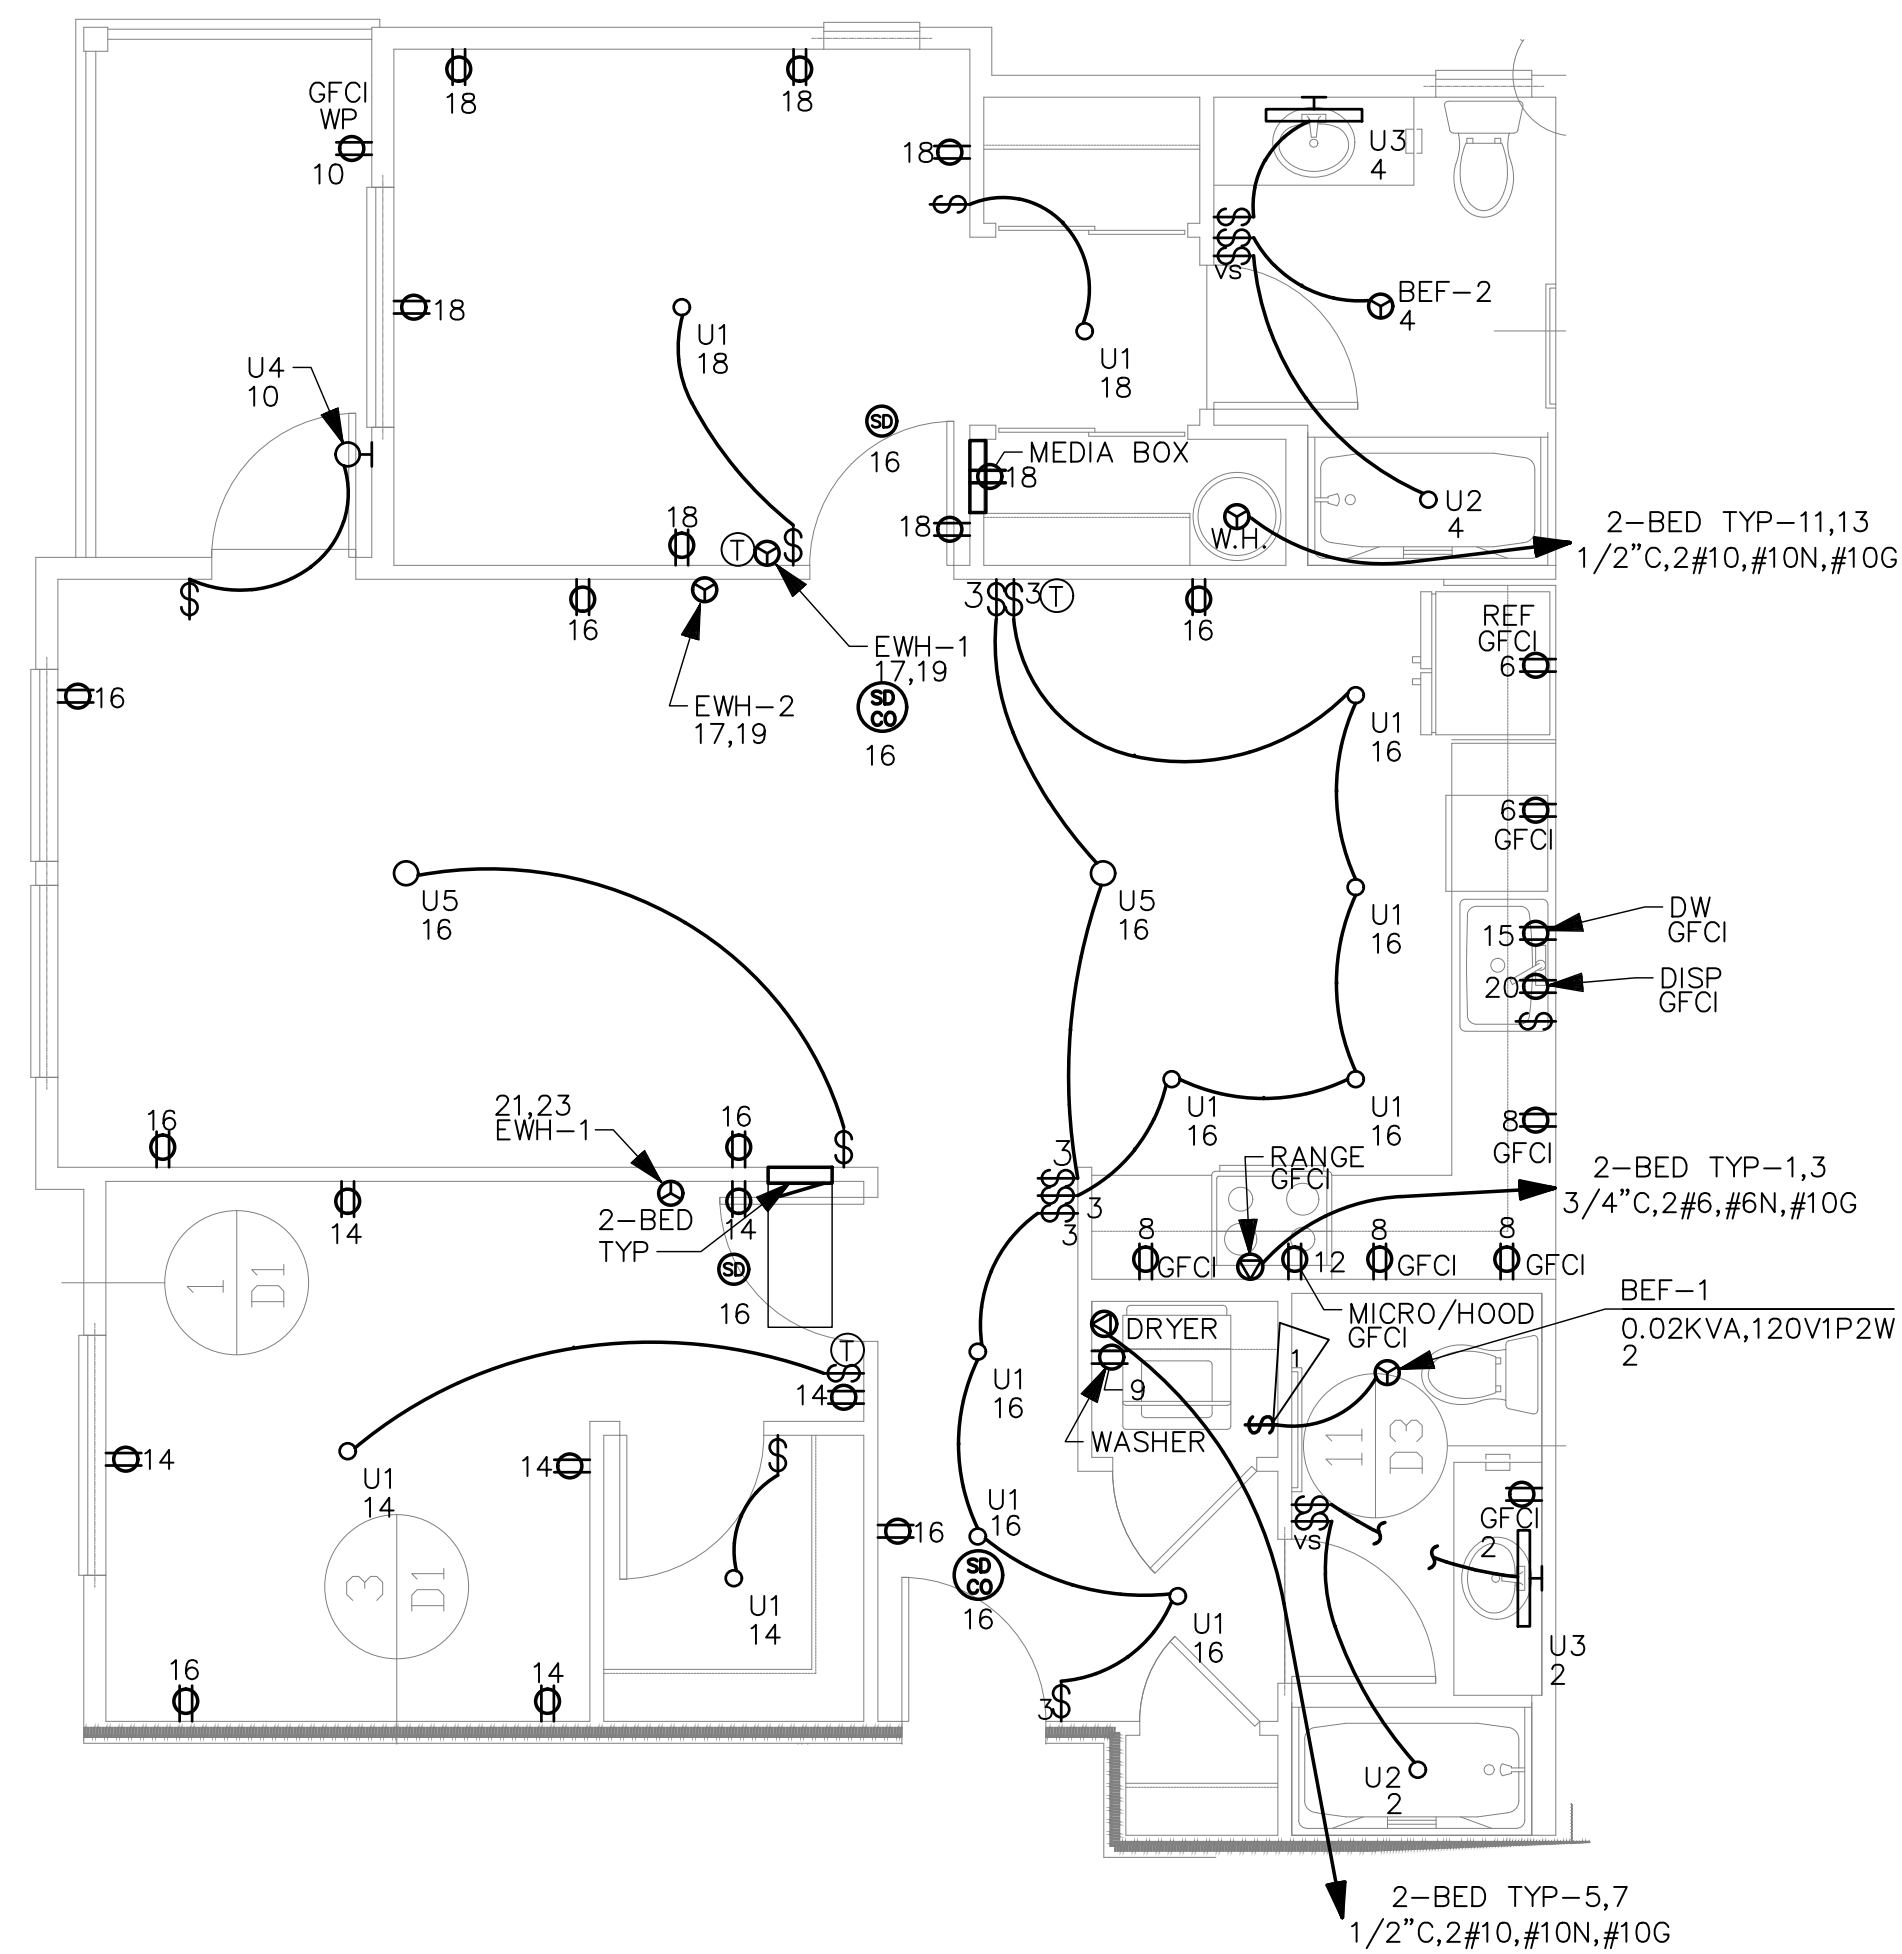

UNIT TYPICALS

2-BED TYP

SCALE: 1/4" = 1'-0"

Panel		ROOM		VOLTS		AIC	
2-BED TYP		LIVING DRYER		208/120V 2P 3W		22,000	
MOUNTING		FLUSH		BUS AMPS		MAIN BKR	
FED FROM		NOTE		125		MLO	
				NEUTRAL		LUGS	
				100%		STANDARD	
CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION	CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION
1	50/2	8	RANGE	a 2	20/1	0.23	ERV, LIGHTING, RECEPTACLE
3				b 4	20/1	0.128	BATH EX FAN, LIGHTING
5	30/2	4.99	DRYER	a 6	20/1	1.5	SMALL APPLIANCE
7				b 8	20/1	1.5	SMALL APPLIANCE
9	20/1	1.5	WASHER	a 10	20/1	0.19	LIGHTING, RECEPTACLE
11	30/2	4.4	WATER HEATER	b 12	20/1	1.58	MICRO/HOOD
13				a 14	20/1	1.28	LIGHTING, RECEPTACLE
15	20/1	1.2	DISHWASHER	b 16	20/1	1.19	LIGHTING, RECEPTACLE
17	20/2	0.75	WALL HEATER	a 18	20/1	1.28	LIGHTING, MEDIA BOX, RECEPTACLE
19				b 20	20/1	0.7	DISPOSAL
21	20/2	1	WALL HEATER	a 22	20/1	0.2	SDCO
23				b 24	20/1	0	SPARE
OPTIONAL DWELLING UNIT CALCULATION (NEC 220.82)							
		CONN KVA		CONN KVA	CALC KVA		
LIGHTING AND RECEPTACLES		3.52	1,173 SF (3 VA/SF)	GENERAL LOAD			
SMALL-APPLIANCE		3		UP TO 10 KVA		10	(100%)
LAUNDRY		1.5		OVER 10 KVA		14.5	5.8 (40%)
APPLIANCES		8.47		MAX HEATING OR COOLING		4	(220.82(C)(4))
ELECTRIC COOKING		8		TOTAL LOAD		19.8	
TOTAL GENERAL LOAD		24.5		BALANCED LOAD		95.2 A	
				PHASE A		99.7%	
				PHASE B		100%	

GENERAL NOTES:

- COORDINATE FINAL LOCATION OF THERMOSTATS, SWITCHES, RECEPTACLES, DATA, PHONE, LIGHT FIXTURES AND J-BOXES WITH ARCHITECTURAL ELEVATIONS AND INTERIOR DESIGN PLANS PRIOR TO ROUGH-IN.
- ADA UNITS SHALL HAVE HOOD CONTROLS INSTALLED IN THE FACE OF THE LOWER CABINET WORK.
- PROVIDE TAMPER RESISTANT RECEPTACLES PER NEC 406.12.
- ALL UNITS: PROVIDE SWITCH CONTROLLING GARBAGE DISPOSAL TO BE LOCATED ABOVE BACKSPLASH NEXT TO SINK OR ON COUNTER. SEE ARCHITECTURE.
- BATHROOM GFCI RECEPTACLES TO HAVE INTEGRAL NIGHTLIGHT.
- RECESSED CEILING LIGHT IN BATHROOM SHALL BE LED RATED FOR WET LOCATIONS W/ SHATTER PROOF LENS.
- ALL RECEPTACLES SHALL MEET REQUIREMENTS OF NEC ARTICLE 210.
- PROVIDE TELEPHONE & CABLE T.V. MEDIA TERMINATION ENCLOSURE (MEDIA BOX): PROVIDE LEVITON COMPACT MEDIA ENCLOSURE OR EQUIVALENT IN WALL WITH TOP NO HIGHTER THAN 60" AFF WITH 120V RECEPTACLE ADJACENT.
- PROVIDE COMBINATION HARDWIRED 120VAC PHOTOELECTRIC SMOKE DETECTOR AND CARBON MONOXIDE DETECTOR WITH BATTERY-BACKUP
 - DETECTOR SHALL BE MINIMUM 6' HORIZONTAL DISTANCE FROM PERMANENT COOKING APPLIANCE PER CFC 90.2.11.8.
 - DETECTOR SHALL BE MINIMUM 3' HORIZONTAL DISTANCE FROM THE DOOR OF A BATHROOM THAT CONTAINS A BATHTUB OR SHOWER PER CFC 90.2.11.8.
 - PROVIDE INTERCONNECTION WIRING SUCH THAT ACTUATION OF ONE ALARM WILL ACTIVATE ALL ALARMS IN THE DWELLING UNIT.
 - COORDINATE WITH AHJ ON INTERCONNECTING EACH DWELLING UNIT INTO THE FIRE ALARM SYSTEM FOR THE BUILDING.
 - COORDINATE WITH AHJ AS TO THE NUMBER AND LOCATION OF DEVICES PRIOR TO ROUGH-IN. DEVICES SHOWN ARE DIAGRAMMATIC.
- DISHWASHER OUTLET SHALL BE ACCESSIBLE. RECEPTACLE SHALL BE LOCATED IN SPACE ADJACENT TO THE DISHWASHER.
- PROVIDE 7-DAY PROGRAMMABLE THERMOSTAT FOR THE LIVING ROOM.


FLAG NOTES

- INTERLOCK ERV/BEF TO ON/OFF SWITCH. PROVIDE PERMANENT LABEL SAYING, "WHOLE HOUSE VENTILATION. LEAVE ON UNLESS OUTDOOR AIR QUALITY IS VERY POOR." ADHERE PERMANENT LABEL TO WALL ABOVE WALL SWITCH.

AFCI/GFCI REQUIREMENTS FOR DWELLING UNITS:

- ALL 15 AND 20A, 120V SINGLE PHASE CIRCUITS NOT INCLUDING THE BATHROOM SHALL BE AFCI PROTECTED (210.12).
- ALL DWELLING UNIT CIRCUITS IN BATHROOMS, GARAGES, OUTDOORS, KITCHENS, LAUNDRY AREAS, AND AREAS WITHIN 6' OF A SINK SHALL BE GFCI PROTECTED (210.8).
 - BATHROOM CIRCUIT TO BE GFCI PROTECTED VIA A GFCI RECEPTACLE, WHILE OTHER CIRCUITS SHALL BE PROTECTED AT THE BREAKER.
- UTILIZE "DUAL FUNCTION" BREAKER WHEN BOTH AFCI AND GFCI PROTECTION IS REQUIRED.

NO.	DATE	DESCRIPTION	REVISIONS



DRAWN: KL	DESIGNED: MHS	CHECKED: PSR	APPROVED: JAY
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHTS APARTMENTS
 27TH AVE SE AND 5TH ST BELLEVUE, WA
 19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343
ROBISON ENGINEERING, INC

DATE: 02/15/24

SHEET TITLE:
UNIT PLANS & SCHEDULES

SHEET NO.
E5.02

REQUIRED ELECTRIC VEHICLE CHARGING INFRASTRUCTURE WAC 427:

- WHERE PARKING IS PROVIDED, TEN PERCENT OF PARKING SPACES SHALL BE PROVIDED WITH ELECTRIC VEHICLE CHARGING INFRASTRUCTURE.
- ELECTRICAL ROOM(S) SERVING PARKING AREAS SHALL BE DESIGNED TO ACCOMMODATE THE ELECTRICAL EQUIPMENT AND DISTRIBUTION REQUIRED TO SERVE A MINIMUM OF 20 PERCENT OF THE TOTAL PARKING SPACES WITH 208/240 V 40-AMP ELECTRIC VEHICLE CHARGING INFRASTRUCTURE.
- MINIMUM ONE ACCESSIBLE PARKING SPACE SHALL BE SERVED BY ELECTRIC VEHICLE CHARGING INFRASTRUCTURE.

TOTAL NUMBER OF PARKING SPACES = 354
 AVERAGE NUMBER OF PARKING SPACES PER BUILDING = $354/8 = 44.25$
 $44.25 \times 0.2 = 8.85$
 5 OUTDOOR EV CHARGERS WITH INFRASTRUCTURE
 4 CONDUITS TO FUTURE EV CHARGING LOCATIONS

CAPACITY FOR 9 CHARGERS $\times 208V/1PH \times 40A = 74.9 KVA = (208)A \ 3$
 PHASE POWER @ 120/208V
 UTILIZING LOAD MANAGEMENT INFRASTRUCTURE, EV LOAD CAN BE REDUCED BY 50%. $208A/2 = 104A @ 208V \ 3$ PHASE

PER WAC 427, ELECTRICAL INFRASTRUCTURE FOR EACH BUILDING SHALL BE DESIGNED TO ACCOMMODATE 104 AMPS OF EV ELECTRICAL LOAD.

GENERAL FEEDER SCHEDULE

ID	FEEDER AMPS	CONDUIT AND FEEDER	FEEDING THESE DEVICES
①	125	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G	A-001, A-002, A-003, A-004, A-101, A-102, A-103, A-104, A-105, A-106, A-107, A-108, A-201, A-202, A-203, A-204, A-205, A-206, A-207, A-208, A-301, A-302, A-303, A-304, A-305, A-306, A-307, A-308, B-001, B-002, B-101, B-102, B-103, B-104, B-201, B-202, B-203, B-204, B-301, B-302, B-303, B-304, C-101, C-102, C-103, C-104, C-105, C-106, C-107, C-108, C-109, C-110, C-111, C-112, C-201, C-202, C-203, C-204, C-205, C-206, C-207, C-208, C-209, C-210, C-211, C-212, C-301, C-302, C-303, C-304, C-305, C-306, C-307, C-308, C-309, C-310, C-311, C-312
②	100	1-1/2" C, 3#1/0 AL, #1/0 AL N, #6 AL G	AM-B, POOL
⑤	1200	(4) 3-1/2" C, 3#500kcmil AL, #500kcmil AL N, #250kcmil AL G	A-MC, C-MC, E-MC, F-MC, G-MC
⑥	800	(3) 3" C, 3#400kcmil AL, #400kcmil AL N, #4/0 AL G	B-MC
⑦	1600	(5) 4" C, 3#600kcmil AL, #600kcmil AL N, #500kcmil AL G	D-MC
⑬	400	(2) 2-1/2" C, 3#250kcmil AL, #250kcmil AL N, #1/0 AL G	AM-CT
⑮	1000	(4) 3" C, 3#350kcmil AL, #350kcmil AL N, #4/0 AL G	H-MC
⑰	400	3-1/2" C, 3#500kcmil, #500kcmil N, #2G	AM-A
⑱	200	2" C, 3#3/0, #3/0N, #6G	A-HOUSE, B-HOUSE, C-HOUSE, D-HOUSE, E-HOUSE, F-HOUSE, G-HOUSE, H-HOUSE

SIZING METHOD: COPPER, 60°C #12 THROUGH #1, 75°C 1/0 AND ABOVE

FEEDER SCHEDULE NOTES:

CONDUIT FILL:

- FOR CONDUIT SIZES 1-1/2" AND BELOW, FILL IS BASED ON EMT.
- FOR CONDUIT SIZES 2" AND ABOVE, FILL IS BASED ON SCHEDULE 40 PVC.

IN LOCATIONS APPROVED FOR THE PURPOSE, CONTRACTOR MAY USE MC CABLE. IN LOCATIONS APPROVED FOR THE PURPOSE CONTRACTOR MAY USE OTHER CONDUIT TYPES, INCLUDING RMC, FMC AND LFMC. CONTRACTOR REQUIRED TO ENSURE CONDUIT FILL DOES NOT EXCEED 40%.

CONTRACTOR RESPONSIBLE TO ENSURE TERMINATION/LUG CAPACITY FOR ALL SCHEDULED FEEDERS.

XHHW/THHN/THWN SHALL BE USED FOR INSULATION OF THE CONDUCTOR.

COORDINATION AND ARC FLASH STUDIES:

IMMEDIATELY UPON SELECTION OF ACTUAL EQUIPMENT BEING PROVIDED FOR THE PROJECT, THE ELECTRICAL CONTRACTOR SHALL PERFORM AN ARC FLASH ANALYSIS AND COORDINATION STUDY ON THE STANDBY DISTRIBUTION BASED ON ACTUAL EQUIPMENT TO BE PROVIDED, CONDUCTOR TYPES/SIZES/LENGTHS, ETC. COORDINATION SHALL BE CONFIRMED BASED ON FAULT NUMBERS SHOWN ON THIS DRAWING.

STUDIES SUBMITTED SHALL BE STAMPED BY A PROFESSIONAL ELECTRICAL ENGINEER HOLDING A CURRENT LICENSE FROM THE STATE OF WA.

PRELIMINARY ARC FLASH AND COORDINATION STUDIES ARE TO BE SUBMITTED WITH THE SUBMITTALS FOR THE PROTECTIVE DEVICES, PANELBOARDS, SWITCHBOARDS, AND OTHER ELECTRICAL EQPT.

THE ELECTRICAL CONTRACTOR SHALL SUBMIT THE STAMPED AND SIGNED ARC FLASH AND COORDINATION STUDY TO THE AHJ AS REQUIRED.

THE ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL PERMANENT LABELS INDICATING ARC FLASH HAZARD RISK CATEGORIES ON ALL DISTRIBUTION POINTS (SWITCHBOARDS, PANELBOARDS, VFDS, DISCONNECT SWITCHES, ETC). LABELS SHALL COMPLY WITH NFPA 70E.

SHEET NOTES:

- CONTRACTOR TO OBTAIN UTILITY APPROVAL OF ALL SERVICE AND METERING EQUIPMENT PRIOR TO ORDERING.
- DISTRIBUTION SYSTEM AS DESIGNED IS FULLY RATED. CONTRACTOR WILL BE RESPONSIBLE FOR ENGINEERING IF SERIES RATED SYSTEMS ARE SUBMITTED, THE SUBMITTED SYSTEM SHALL MEET NEC 240.86(B) REQUIREMENTS FOR TESTED COMBINATIONS, AND SHALL NOT BE USED IF MOTOR CONTRIBUTION EXCEEDS LIMITS PER 240.86(C). NEC 110.22 MARKING REQUIREMENTS MUST BE MET.
- PROVIDE PERMANENT WARNING LABELS FOR ARC FLASH AND PPE REQUIREMENTS FOR THE SERVICE EQUIPMENT AND PANELS.

FLAG NOTES:



- GROUNDING ELECTRODE CONDUCTOR AND SYSTEM GROUNDING SIZED PER N.E.C. 250
- PROVIDE ARC ENERGY REDUCTION: ENERGY REDUCING MAINTENANCE SWITCH PER NEC 240.87(B)(3)
- PROVIDE A LISTED SURGE PROTECTIVE DEVICE FOR DWELLING UNITS AS REQUIRED BY NEC 230.67. CONTRACTOR TO CONFIRM LOCATION IS ACCEPTABLE TO AUTHORITY HAVING JURISDICTION. OBTAIN PRICING FOR OPTION TO HAVE SPDs LOCATED IN UNIT PANELS VS UPSTREAM.
- METER ELEVATIONS AND METERS PER STACK SHALL BE INSTALLED PER UTILITY ELECTRICAL PROVIDER REQUIREMENTS. METER SOCKET IN ELECTRICAL ROOM. VERIFY EXACT LOCATION AND REQUIREMENTS WITH ELECTRIC UTILITY (TYPICAL)
- PROVIDE (1) 2 1/2" CONDUITS FOR SOLAR READY PATHWAY AND RESERVE SPACE IN THE MAIN ELECTRICAL ROOM FOR FUTURE SOLAR EQUIPMENT. RESERVE SPACE FOR INSTALLATION OF FUTURE SOLAR CIRCUIT BREAKER AND PERMANENTLY MARK THIS LOCATION AS "FOR FUTURE SOLAR ELECTRIC".

GROUNDING NOTES AND REQUIREMENTS:

THE ELECTRICAL CONTRACTOR SHALL COORDINATE WITH THE GENERAL CONTRACTOR, POWER COMPANY, PHONE COMPANY, INTERNET COMPANY, CABLE TV COMPANY, AND THE SATELLITE TV COMPANY TO ENSURE REQUIRED GROUNDING IS INSTALLED FOR EACH SYSTEM.


THIS SHALL BE DONE PRIOR TO AND DURING INSTALLATION OF FOUNDATION RE-BAR AND CONTINUE DURING THE CONSTRUCTION PHASES, TO ENSURE EACH SYSTEM HAS IT'S REQUIRED GROUNDING INSTALLED FOR PROPER OPERATION OF THE SYSTEM.

- THE ELECTRICAL CONTRACTOR SHALL COORDINATE AND PROVIDE WHAT IS REQUIRED TO DO THE FOLLOWING:
- FOOTING GROUND RE-BAR COMES UP IN THE ELECTRICAL ROOM AND THE RE-BAR IS SNUGLY SECURED TO THE FOOTING RE-BAR.
- THE MSB GROUNDING TIES TO THE FOOTING RE-BAR, COUNTERPOISE, BUILDING STEEL, AND WATER PIPING.
- THE GROUND WIRE FOR THE COUNTERPOISE SHALL BE STRANDED, INSULATED WIRE IN CONDUIT UNTIL IT REACHES THE FIRST BAR OF THE COUNTERPOISE. BETWEEN THE COUNTERPOISE BARS IT SHALL BE A STRANDED BARE COPPER WIRE.

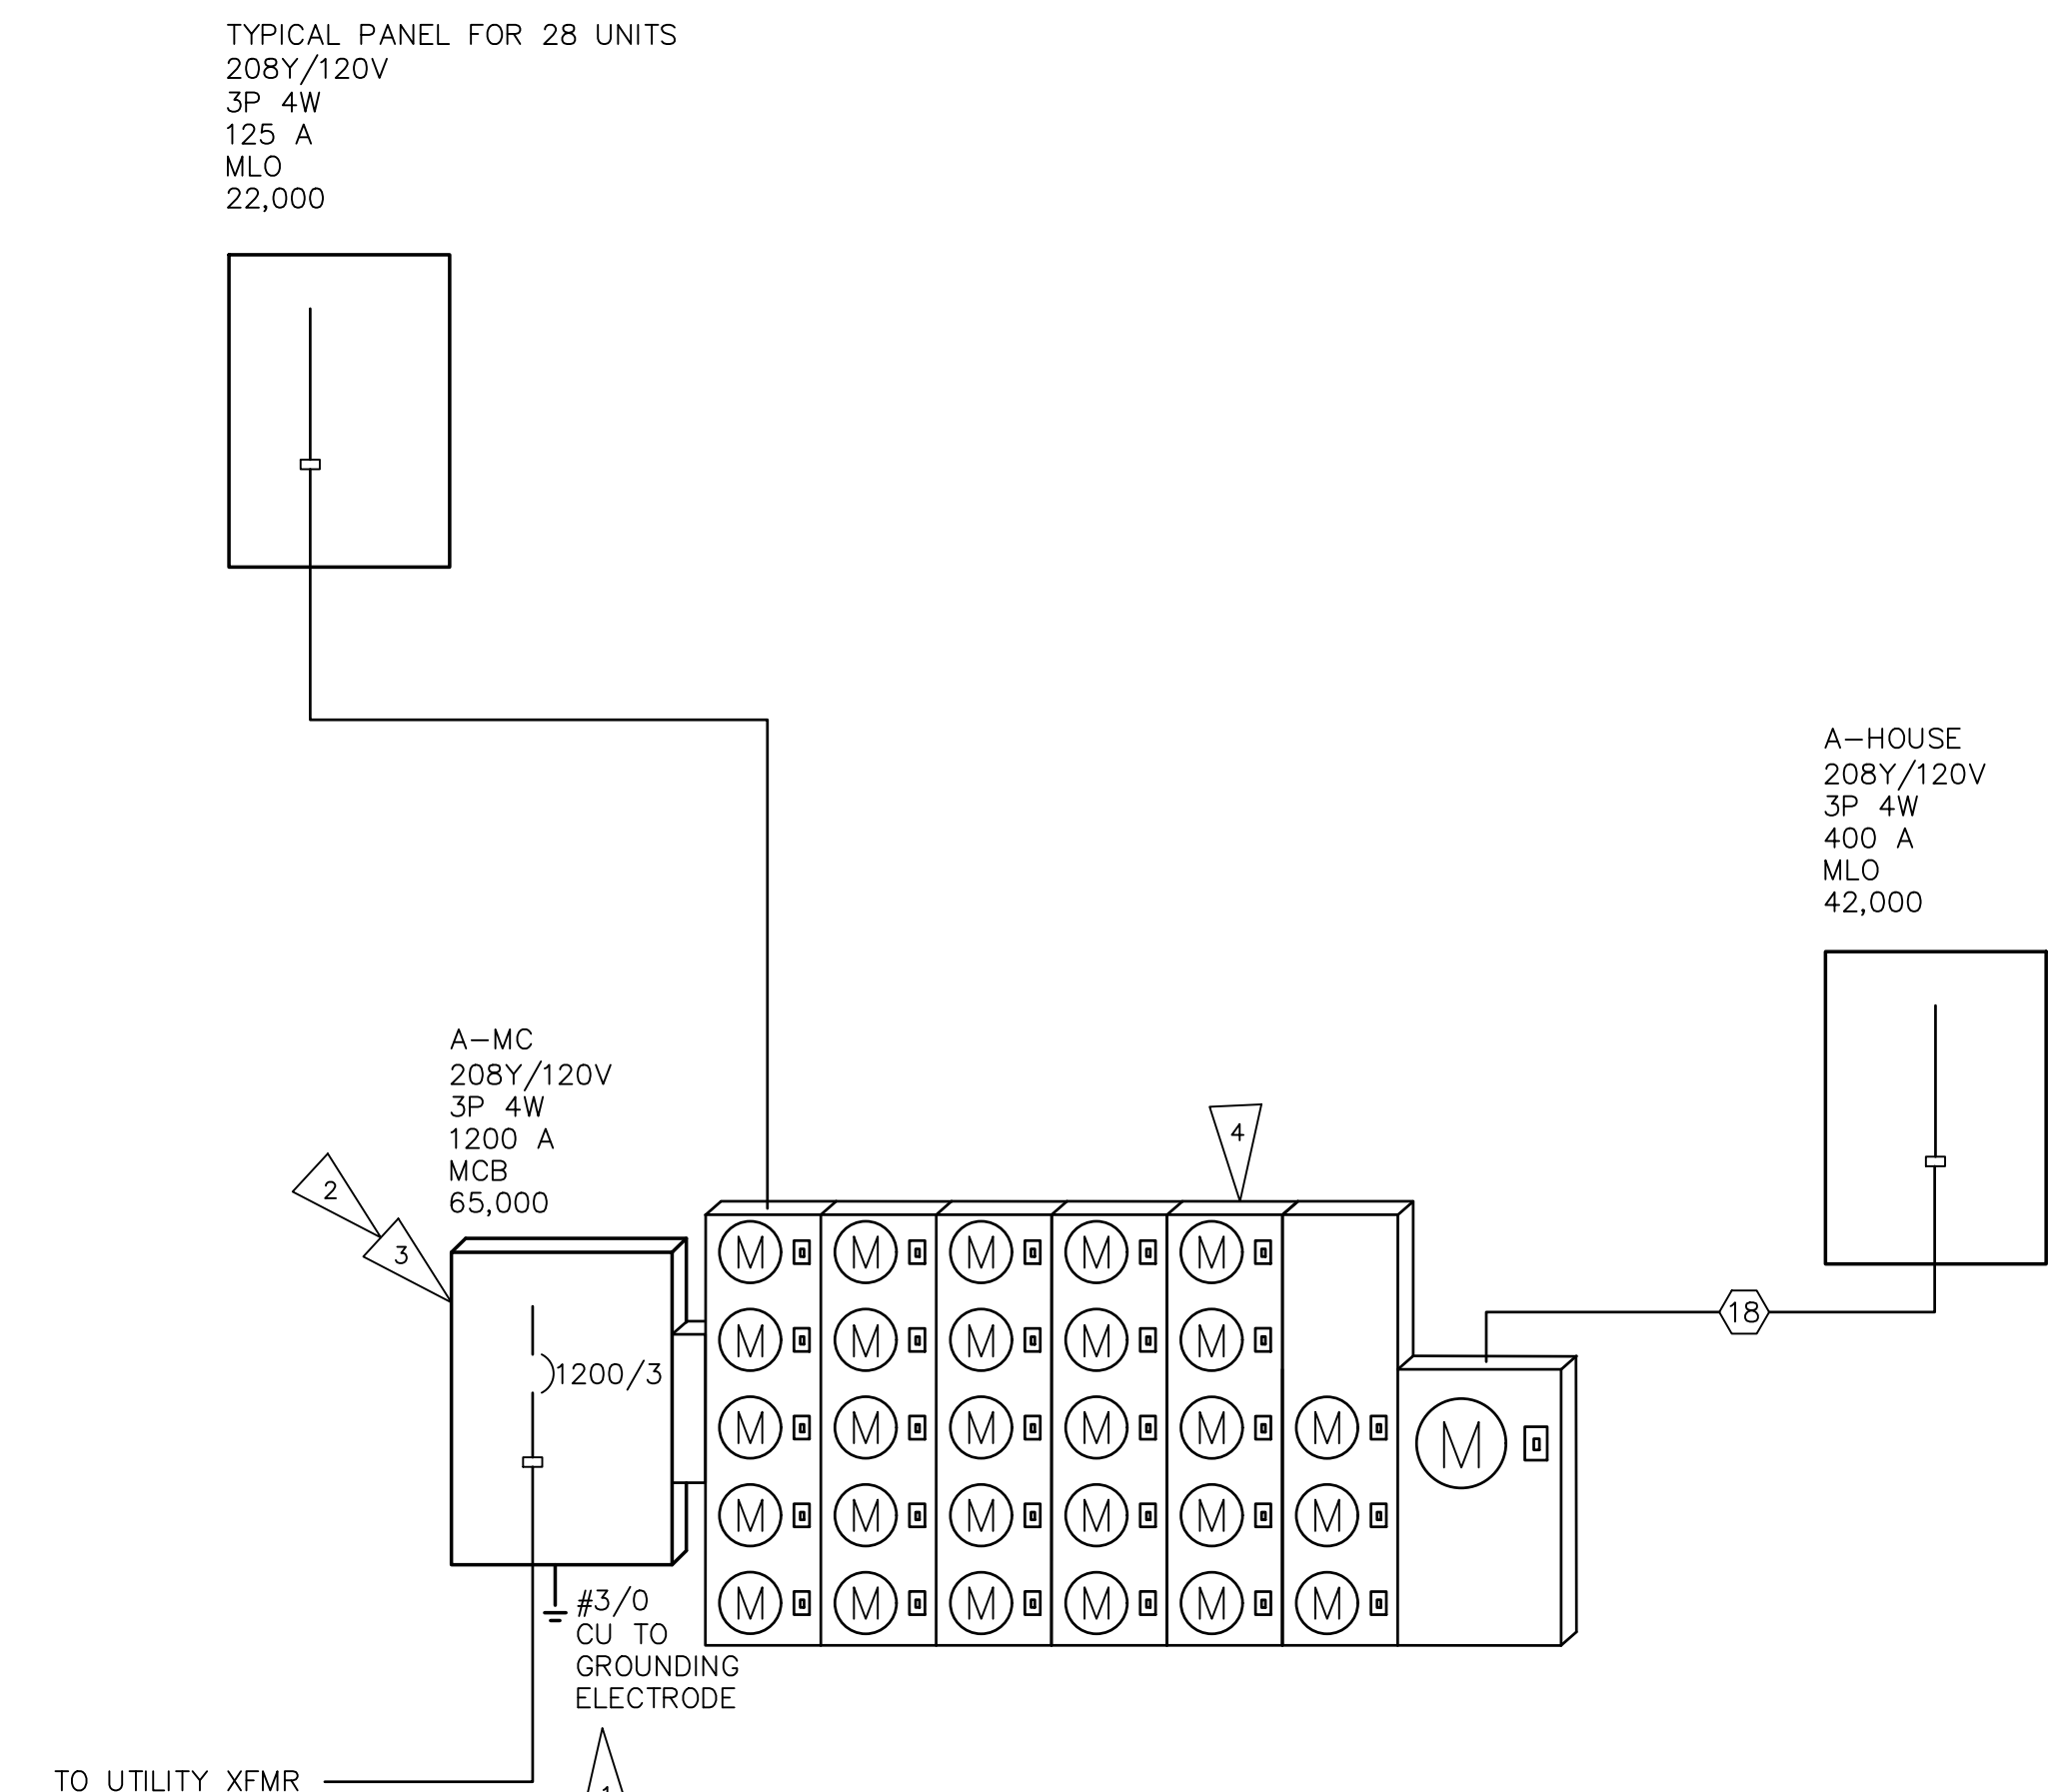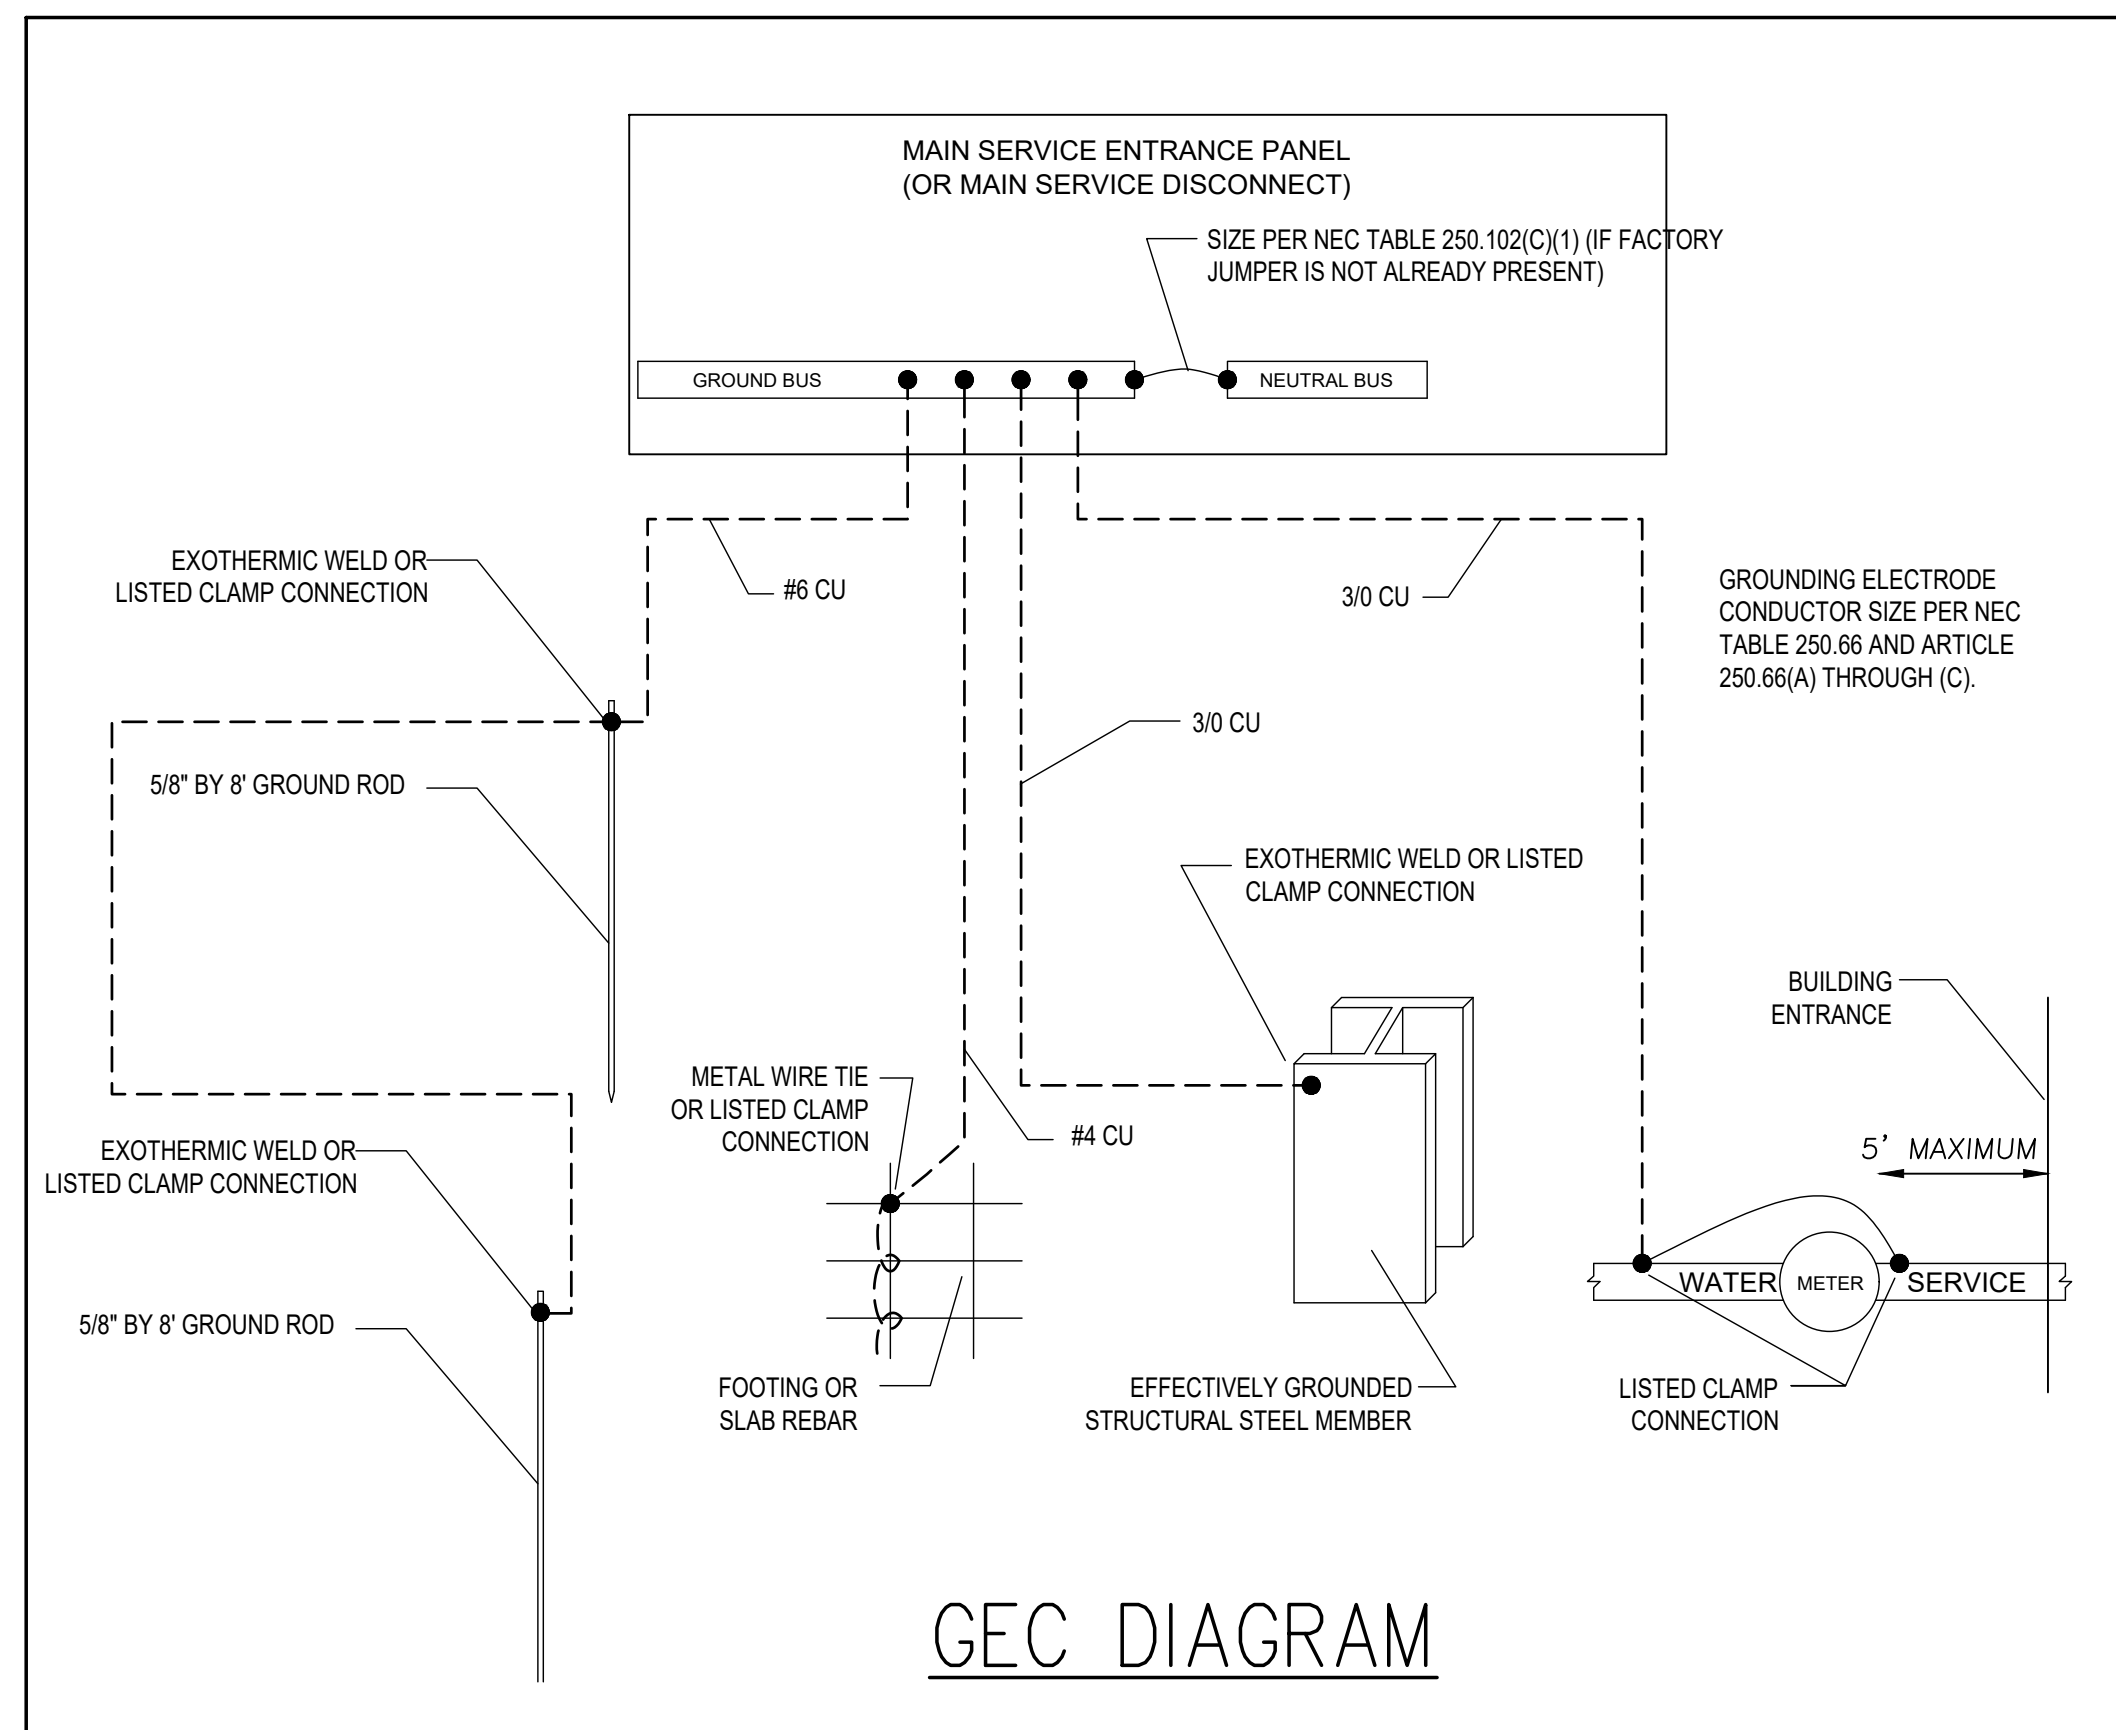

ONE-LINE DIAGRAM

NO.	DATE	DESCRIPTION	REVISIONS

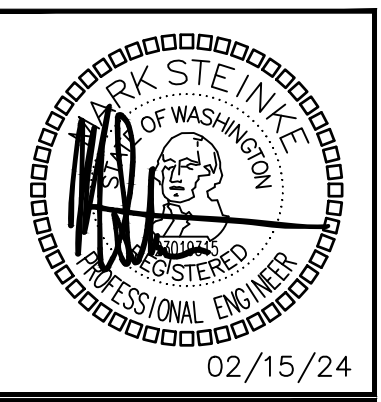

DRAWN: KL	DESIGNED: MHS	CHECKED: PSR	APPROVED: JAY
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHTS APARTMENTS
 27TH AVE SE AND 5TH ST BELLEVUE, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343

ROBISON ENGINEERING, INC.

DATE: 02/15/24

SHEET TITLE:
ONE-LINE DIAGRAM & NOTES

SHEET NO.
E6.00

FAULT CURRENT SCHEDULE

DEVICE	FAULT	AIC RATING	UTILITY	FED FROM		FEEDER		TOTAL MOTOR FAULT
				FAULT	DEVICE	FAULT	SIZE	
XFMR A/B	60,356	N/A	60,300					56
A-MC	27,488	65,000	27,470	XFMR A/B	60,300	(4)#350kcmil	150'	18
A-HOUSE	19,790	42,000	19,776	A-MC	27,470	#3/0	21'	14
B-MC	41,173	65,000	41,135	XFMR A/B	60,300	(3)#400kcmil	50'	38
B-HOUSE	27,899	42,000	27,880	B-MC	41,135	#3/0	18'	19
AM-CT	35,169	42,000	35,077	XFMR C/D/CLUB	60,300	(2)#250kcmil	35'	92
AM-DISC	26,482	42,000	26,401	AM-CT	35,077	(2)#250kcmil	23'	81
AM-A	19,729	22,000	19,654	AM-DISC	26,401	#500kcmil	33'	75
AM-B	4,374	22,000	4,371	AM-A	19,654	#1/0 AL-1	108'	3
POOL	11,018	22,000	10,948	AM-A	19,654	#1/0 AL-1	26'	70
C-MC	42,261	65,000	42,184	XFMR C/D/CLUB	60,300	(4)#500kcmil	68'	77
C-HOUSE	27,865	42,000	27,827	C-MC	42,184	#3/0	19'	38
D-MC	23,543	65,000	23,500	XFMR C/D/CLUB	60,300	(5)#600kcmil	311'	43
D-HOUSE	18,268	42,000	18,233	D-MC	23,500	#3/0	19'	35
E-MC	42,604	65,000	42,578	XFMR E/F	60,300	(4)#500kcmil	66'	26
E-HOUSE	27,324	42,000	27,309	E-MC	42,578	#3/0	21'	15
F-MC	28,349	65,000	28,329	XFMR E/F	60,300	(4)#500kcmil	170'	20
F-HOUSE	17,775	42,000	17,763	F-MC	28,329	#3/0	31'	12
G-MC	46,251	65,000	46,216	XFMR G/H	60,300	(4)#500kcmil	49'	35
G-HOUSE	30,018	42,000	29,998	G-MC	46,216	#3/0	19'	20
H-MC	35,470	65,000	35,447	XFMR G/H	60,300	(4)#350kcmil	92'	23
H-HOUSE	20,315	42,000	20,305	H-MC	35,447	#3/0	31'	10

Panel		ROOM MOUNTING SURFACE		VOLTS 208Y/120V 3P 4W		AIC 42,000	
A-HOUSE		BUS AMPS 200		NEUTRAL 100%		MAIN BKR MLO	
LUGS STANDARD							
CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION	CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION
1	20/1	0.72	RECEPTACLE	a 2	40/2	6.6	EV CHARGER
3	20/1	0.72	RECEPTACLE	b 4			
5	20/1	0.307	LIGHTING	c 6	40/2	6.6	EV CHARGER
7	20/1	0.307	LIGHTING	a 8			
9	20/1	0.18	RECEPTACLE	b 10	40/2	6.6	EV CHARGER
11	20/1	0.18	RECEPTACLE	c 12			
13	20/1	0.5	HEAT TRACE	e 14	40/2	6.6	EV CHARGER
15	20/1	0.096	LIGHTING	b 16			
17	20/1	0.144	SITE LIGHTING	c 18	40/2	6.6	EV CHARGER
19	-/1	0.5	SPACE	a 20			
21	-/1	0	SPACE	b 22	40/2	6.6	(F) EV CHARGER
23	-/1	0	SPACE	c 24			
25	-/1	0	SPACE	e 26	40/2	6.6	(F) EV CHARGER
27	-/1	0	SPACE	b 28			
29	-/1	0	SPACE	c 30	40/2	6.6	(F) EV CHARGER
31	-/1	0	SPACE	a 32			
33	-/1	0	SPACE	b 34	40/2	6.6	(F) EV CHARGER
35	-/1	0	SPACE	c 36			
37	-/1	0	SPACE	a 38	-/3	0	SOLAR BREAKER
39	-/1	0	SPACE	b 40			
41	-/1	0	SPACE	c 42			

		CONN KVA		CALC KVA			
LIGHTING	0.854	1.07	(125%)	EV LOAD	59.4	37.1	(63%)
RECEPTACLES	1.8	1.8	(50%>10)	CONTINUOUS	0.5	0.625	(125%)
				HEATING	0.5	0.5	(100%)
				TOTAL LOAD	41.1		
				BALANCED 3-PHASE LOAD	114 A		
				PHASE A	104%		
				PHASE B	98.9%		
				PHASE C	97.2%		

Panel		ROOM MOUNTING SURFACE		VOLTS 208Y/120V 3P 4W		AIC 65,000	
A-MC		BUS AMPS 1000		NEUTRAL 100%		MAIN BKR 1000	
LUGS STANDARD							
CKT #	BREAKER TRIP/POLES	CIRCUIT DESCRIPTION		LOAD KVA			FEEDER RACEWAY AND CONDUCTORS
		A	B	C			
1	125/2	15.8	15.7		1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
2	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
3	125/2	15		15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
4	125/2	16.5		15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
5	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
6	125/2		15.8	15.8	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
7	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
8	125/2		15.8	15.8	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
9	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
10	125/2	16.5		16.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
11	125/2		15.8	15.8	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
12	125/2		15.8	15.8	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
13	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
14	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
15	125/2		15.8	15.8	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
16	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
17	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
18	125/2	16.7		16.5	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
19	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
20	125/2		16.5	16.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
21	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
22	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
23	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
24	125/2		15.8	15.8	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
25	125/2		15.8	15.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
26	125/2		16.5	16.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
27	125/2		15.8	15.8	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
28	125/2	16.5		16.7	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G		
29	200/3	20.2	21.8	20.8	2" C, 3#3/0, #3/0N, #6G		

TOTAL CONNECTED KVA BY PHASE				322	325	307
------------------------------	--	--	--	-----	-----	-----


OPTIONAL MULTIFAMILY DWELLING CALCULATION (NEC 220.84)

DWELLING UNIT LOADS							
	KVA			KVA			
	LIGHTING AND RECEPTACLES	78.6	26,187 SF	CONNECTED LOAD	864		
SMALL-APPLIANCE	84	(3 VA/SF)	DWELLING UNITS	28			
LAUNDRY	42		DEMAND FACTOR	(33%)			
APPLIANCES	237		CALCULATED LOAD	285			
ELECTRIC COOKING	224						
HEATING	199	(100%)					

HOUSE LOADS							
	CONN KVA	CALC KVA		CONN KVA	CALC KVA		
LIGHTING	0.628	0.785	(125%)	EV LOAD	59.4	37.1	
RECEPTACLES	1.8	1.8	(50%>10)	CONTINUOUS	0.5	0.625	
				HEATING	0.5	0.5	
TOTAL HOUSE LOAD				40.8			

TOTAL LOAD							
	KVA			KVA			
TOTAL DWELLING UNIT LOAD	285			TOTAL LOAD	326		
TOTAL HOUSE LOAD	40.8			BALANCED 3-PHASE LOAD	905 A		

NO.	DATE	DESCRIPTION	REVISIONS

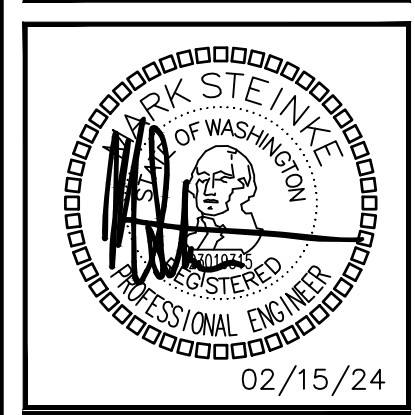

ROBISON ENGINEERING, INC.
19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 P: 206-864-3317
 F: 206-864-3318
 REG PROJECT NO. 129901
 CONTACT: AME@REIWA.COM

DRAWN: KL	DESIGNED: MHS	CHECKED: PSR	APPROVED: JAY
-----------	---------------	--------------	---------------

PROJECT: BRADLEY HEIGHTS APARTMENTS
 27TH AVE SE AND 5TH ST BELLEVUE, WA
ROBISON ENGINEERING, INC.
 19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206/364-3343

DATE: 02/15/24

SHEET TITLE:
PANELS SCHEDULES

SHEET NO.
E6.01

GENERAL NOTES

- REFERENCE TO RELATED WORK: "REF" INDICATIONS DENOTE WORK COVERED ELSEWHERE (ARCHITECTURAL, STRUCTURAL, CIVIL, ELECTRICAL, LANDSCAPE, OR KITCHEN), OR ITEM BASED ON A SPECIFIC MANUFACTURER'S DIMENSIONS (VERIFY).
- ELECTRICAL CHARACTERISTICS: REFER TO ELECTRICAL DRAWINGS FOR ELECTRICAL CHARACTERISTICS (VOLTAGES, ETC. OF MECHANICAL EQUIPMENT, UNLESS OTHERWISE INDICATED).
- CODES: COMPLETE INSTALLATION OF THE PLUMBING SYSTEM SHALL BE PER THE APPLICABLE BUILDING, MECHANICAL, ENERGY, PLUMBING, FIRE, AND HEALTH CODES AND REGULATIONS AS ADOPTED BY THE LOCAL AHJ.
- PREPARE AND SUBMIT FOR REVIEW A SHOP DRAWING BASED ON FINAL STRUCTURAL SHOP DRAWINGS FOR LOCATING AND ROUTING ALL EQUIPMENT, PIPING, ETC.
 - COORDINATE FLOOR AND BEAM PENETRATIONS WITH STRUCTURAL.
 - COORDINATE FINAL LOCATION AND ROUTING WITH CEILING, LIGHTS, WALLS, FIRE SPRINKLER PIPING, AND OTHER TRADES WORK.
 - INCLUDE ADDITIONAL OFFSETS, ELBOWS, ROUTING, EQUIVALENT DUCT SIZING EXCHANGE, RELOCATING, ETC. AS REQUIRED FOR A COMPLETE OPERATING MECHANICAL SYSTEM.
 - PROVIDE SHOP DRAWINGS AT NO ADDITIONAL COST TO THE OWNER.
- PLUMBING CONTRACTOR SHALL LOCATE AND COORDINATE EXACT LOCATION OF ALL PLUMBING EQUIPMENT WITHIN THE STRUCTURE.
- ACCESS DOORS: COORDINATE WITH ARCHITECT AND LOCATE ALL ACCESS DOORS ON SHOP DRAWINGS PRIOR TO BEGINNING OF CONSTRUCTION. ACCESS DOORS IN FIRE RATED STRUCTURE SHALL BE FIRE RATED. VERIFY ACCESS DOOR LOCATIONS WITH GENERAL CONTRACTOR PRIOR TO BIDDING.
- ROOF PENETRATIONS: SEE ARCHITECTURAL DRAWINGS FOR ROOF CAP, ROOF CURB, ROOF DRAIN, OVERFLOW DRAINS AND VTR DETAILS.
- EXPOSED PIPING: PROVIDE CHROME PLATING FOR EXPOSED PIPING IN FINISHED ROOMS.
- PENETRATIONS: PROVIDE ESCUTCHEON PLATES FOR EXPOSED PIPING PENETRATIONS AND SHEET METAL FLASHING FOR EXPOSED DUCTWORK PENETRATIONS.
- SHAFT AND PLENUM CONNECTIONS: SEAL CONNECTIONS TO AIR SHAFTS AIRTIGHT. PROVIDE AIRTIGHT SEAL AROUND PENETRATIONS IN AIR PLENUMS.
- LIGHT FIXTURE CLEARANCE: COORDINATE LOCATIONS OF MECHANICAL WORK TO PROVIDE CLEARANCES OVER LIGHTING FIXTURES FOR REMOVAL AND REPLACEMENT.
- CABLE TRAYS: PIPING INSTALLED ADJACENT TO ELECTRICAL CABLE TRAYS SHALL ALLOW MINIMUM ACCESS OF 6" ABOVE AND TO THE SIDE OF CABLE TRAYS.
- MOTORS: COMPLY WITH ENERGY CODE ENFORCED BY AHJ FOR MINIMUM EFFICIENCIES UNDER FULL LOAD.
- ACCESS CLEARANCES FOR MAINTENANCE AND REPLACEMENT: VERIFY PHYSICAL DIMENSIONS OF EQUIPMENT TO ENSURE THAT ACCESS CLEARANCES CAN BE MET. COORDINATE LOCATIONS OF MECHANICAL WORK AND WORK OF OTHER TRADES TO PROVIDE ACCESS CLEARANCES FOR SERVICE AND MAINTENANCE.

COORDINATION REQUIREMENTS


- IRRIGATION SYSTEM: COORDINATE IRRIGATION WATER DEMAND, MINIMUM WATER PRESSURE REQUIREMENTS & CONTROL CABINET LOCATIONS WITH IRRIGATION CONTRACTOR.
- GAS: CONTRACTOR/GAS COMPANY SHALL FINALIZE GAS METER AND GAS SERVICE LOCATIONS. INSTALL SEISMIC GAS SHUT OFF VALVE PER GAS COMPANY REGULATIONS.
- UTILITIES: COORDINATE WITH SITE UTILITY CONTRACTOR AND CIVIL DRAWINGS FOR UTILITY CONNECTIONS AND EXTENSIONS.
- ROOF DRAINAGE: COORDINATE WITH GENERAL CONTRACTOR FOR ROOF DRAIN AND OVERFLOWS, SCUPPER DRAINS, AND CONDENSATE DRAINS.
- PLUMBING FIXTURES & EQUIPMENT: COORDINATE EXACT LOCATION OF ALL PLUMBING FIXTURES & EQUIPMENT WITH ARCHITECTURAL AND OTHER TRADES DOCUMENTS.
- PIPING: COORDINATE EXACT LOCATION OF ALL STRUCTURAL FRAMING & FOOTINGS AND FINALIZE THE EXACT ROUTING OF ALL PIPES WITH STRUCTURAL ENGINEER AT THE SITE PRIOR TO AND DURING THE CONSTRUCTION. COORDINATE UNDER GRADE PIPING & FOUNDATION DRAINAGE PIPING WITH CIVIL ENGINEER.
- ADJUSTMENTS: ALL EQUIPMENT, MOTORS, FANS GAS BURNERS, IGNITION DEVICES, DRIVES, ETC. SHALL BE ADJUSTED AND BALANCED TO OPERATE AT SPECIFIED RATINGS AS REQUIRED FOR THIS PROJECT SITE AND ACCOUNTING FOR ELEVATION ABOVE SEA LEVEL.
- APPROVALS: MECHANICAL AND PLUMBING EQUIPMENT SHALL BE APPROVED FOR INSTALLATION IN THE PROJECT LOCATION AND SHALL HAVE ALL CERTIFICATIONS AND RATINGS TO MEET ALL ENERGY, POLLUTION, ENVIRONMENTAL, SEISMIC, APPLICABLE CODES AND REGULATIONS. THE CONTRACTOR SHALL COORDINATE WITH MANUFACTURE SUPPLIERS AND SHALL INCLUDE ALL COSTS REQUIRED TO MEET THE BID DOCUMENTS.
- FIRE PROTECTION: CONTRACTOR SHALL PROVIDE A FULLY DESIGNED FIRE PROTECTION SPRINKLER SYSTEM IN COMPLIANCE WITH NFPA AND LOCAL CODES. PROVIDE DESIGN, PERMITS, MATERIALS, INSTALLATION, TESTING AND ALL OTHER FOR A FULLY OPERATIONAL SYSTEM. LOCATION OF ALL PIPING TO BE COORDINATED WITH OTHER TRADES.
- PRIOR TO PIPING INSTALLATION: PLUMBING CONTRACTOR TO COORDINATE PIPING LAYOUT WITH ALL OTHER TRADES.
- ACCESS: COORDINATE ALL ACCESS LOCATIONS WITH GENERAL CONTRACTOR AND ARCHITECT TO ENSURE ALL REQUIRED ACCESS HATCHES, ACCESS PANELS & ACCESS COVERS ARE PROVIDED.
- PROVIDE WATER TIGHT SEALS FOR ANY PIPING PENETRATING THE EXTERIOR FOUNDATION WALLS OR SLABS.
- ANY DISCREPANCIES SHOULD BE REPORTED TO THE ARCHITECT IMMEDIATELY.
- PROVIDE FIRE PROOFING FOR ALL PIPING PENETRATING FIRE BARRIER WALLS OR FLOOR SLABS.

DISINFECTION OF POTABLE WATER SYSTEM REQUIREMENTS


- NEW OR REPAIRED POTABLE WATER SUPPLY SYSTEMS SHALL BE DISINFECTED PRIOR TO USE.
- INITIAL COLIFORM SAMPLE IS REQUIRED PRIOR TO ADMINISTERING WATER-CHLORINE SOLUTION.
- SECTION 609.9 ITEMS #2 OR #3 CAN BE USED PRECEDED BY AND FOLLOWED BY ITEM #1.
- NOTE FILL PORT TO ADD CHLORINE MUST BE WHERE WATER SUPPLY ENTERS BUILDING AND A FLOW METER TO MEASURE SOLUTION.
- AFTER WATERCHLORINE SOLUTION IS INCORPORATED INTO THE NEW OR REPAIRED WATER SUPPLY SYSTEM A 48 HOUR WAITING PERIOD MUST BE OBSERVED PRIOR TO BACTERIOLOGICAL TEST.
- BACTERIOLOGICAL TEST SHALL BE CONDUCTED BY A LABORATORY CERTIFIED FOR DRINKING WATER IN WASHINGTON STATE AFFIRMING WATER QUALITY CONTAINS NO COLIFORM BY SAMPLE TESTING THE FURTHEST FIXTURE FROM PUBLIC WATER SOURCE AND NOT LESS THAN TWO OTHER LOCATIONS PART OF THE WATER SUPPLY SYSTEM.
- CHLORINE LEVEL IN THE NEW OR REPAIRED WATER SUPPLY SYSTEM SHALL NOT BE LESS THAN THE MEAN AVERAGE OF THE AREA IN RELATIONSHIP FROM THE WATER PURVEYOR SOURCE.
- WARNING: IN CASE A WATER SOFTENER IS PART OF THE COLD WATER SYSTEM, CONTRACTOR TO ENSURE THE WATER SOFTENER IS CONNECTED AND OPERATIONAL BEFORE STARTING THE DISINFECTION PROCESS. FAILURE TO FOLLOW THE INSTRUCTIONS WILL VOID THE WATER HEATER OR HEAT PUMP WARRANTY.

SYMBOLS


GENERAL

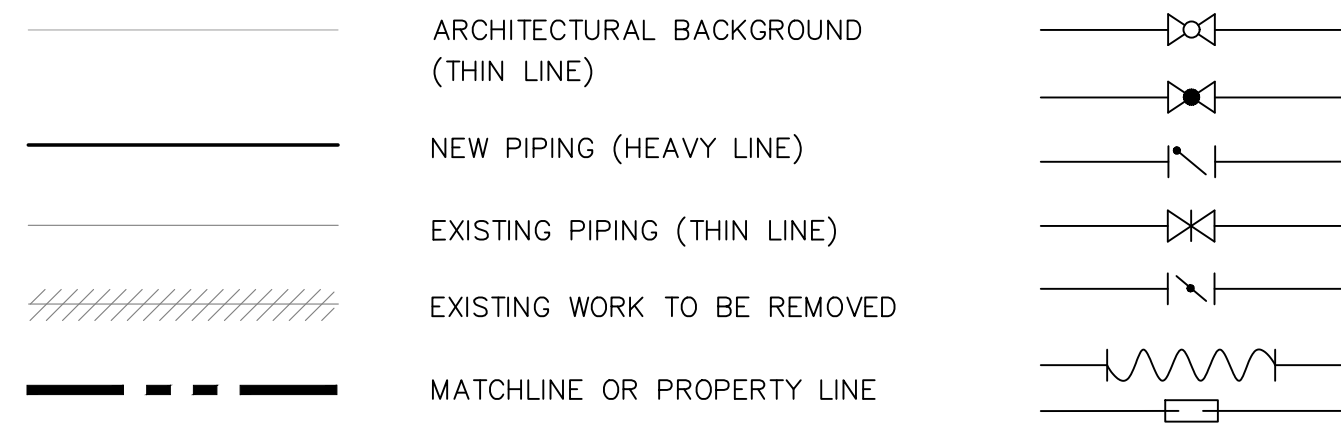

SECTION IDENTIFICATION

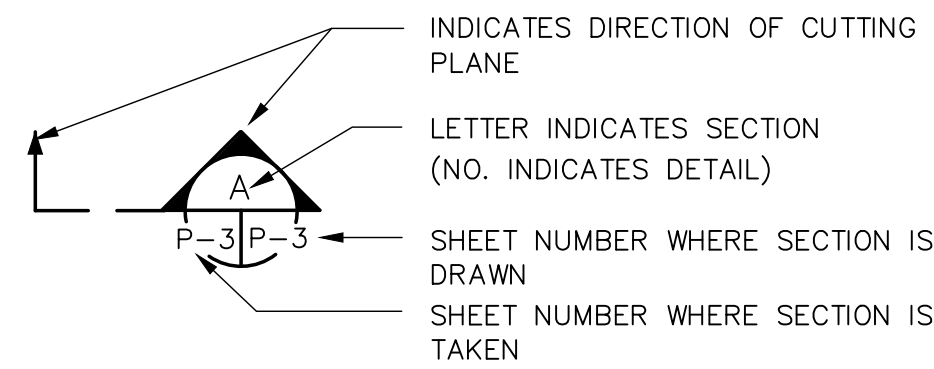


DETAIL IDENTIFICATION

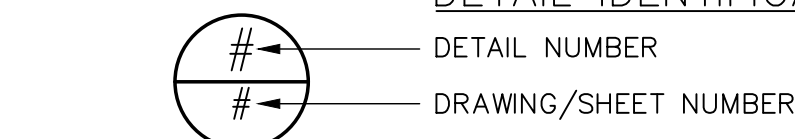



EQUIPMENT



PIPING

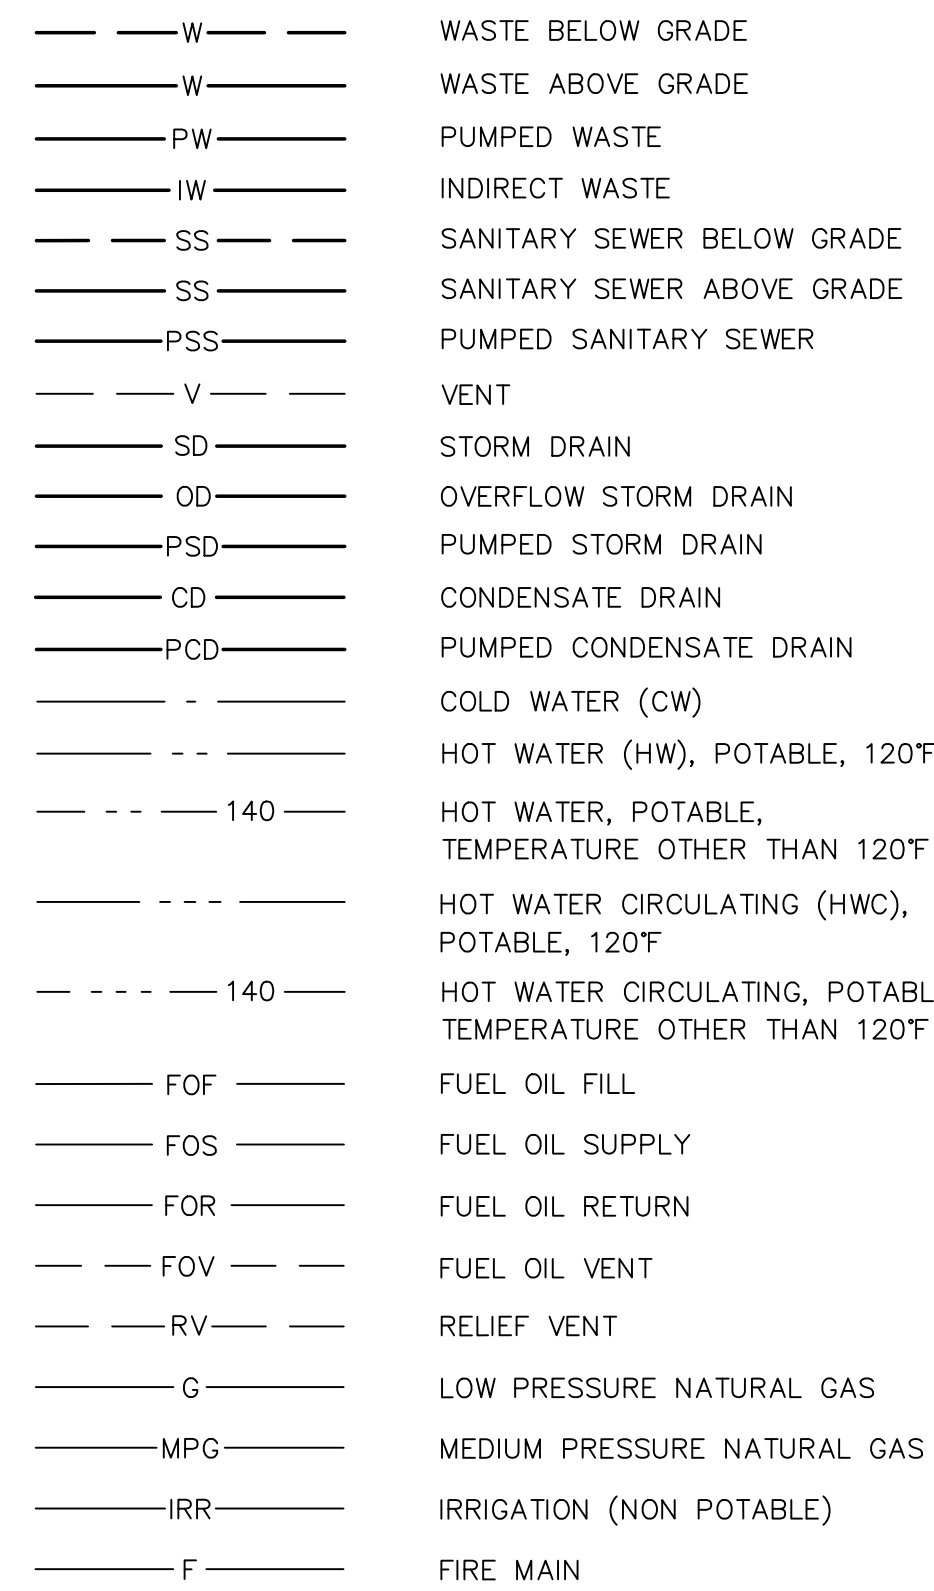

PIPE SYMBOLS

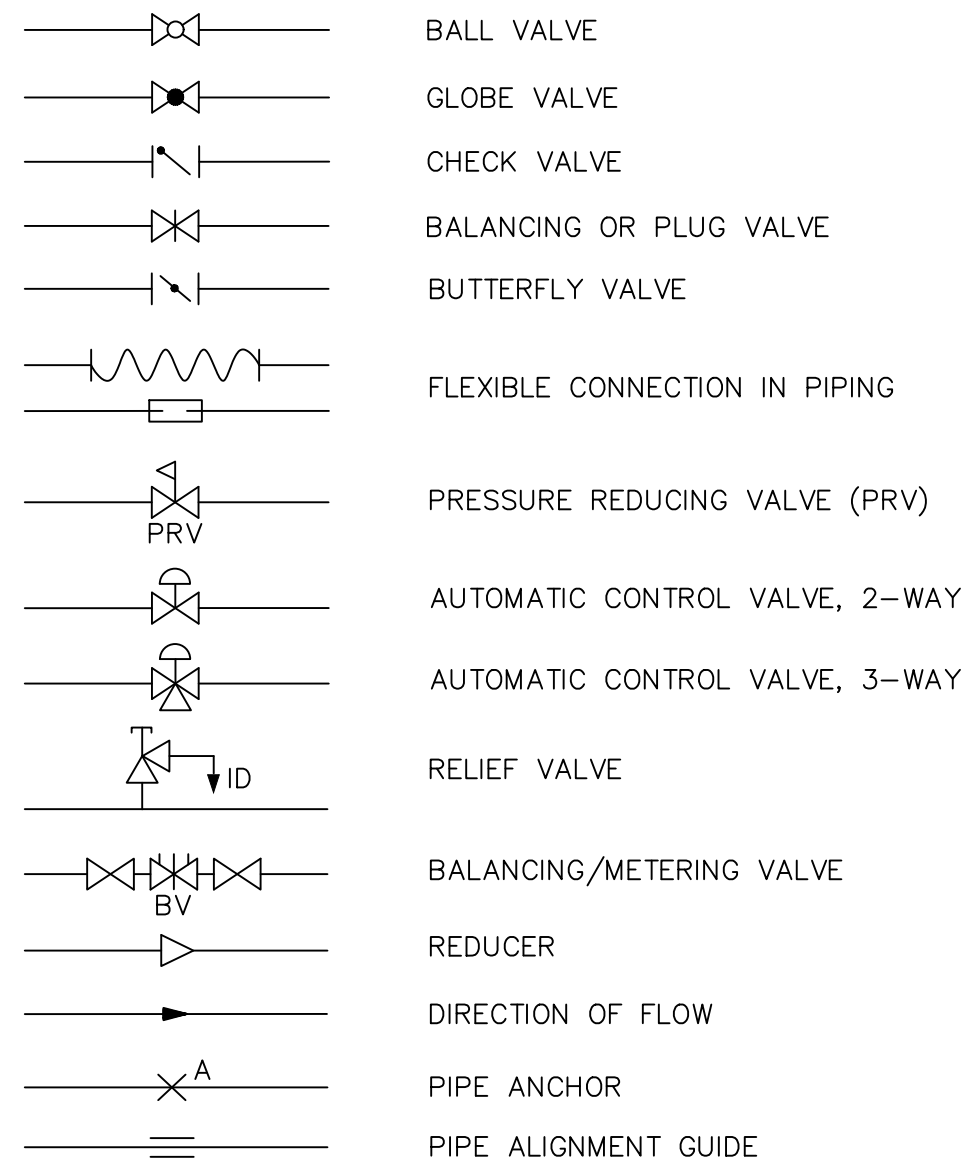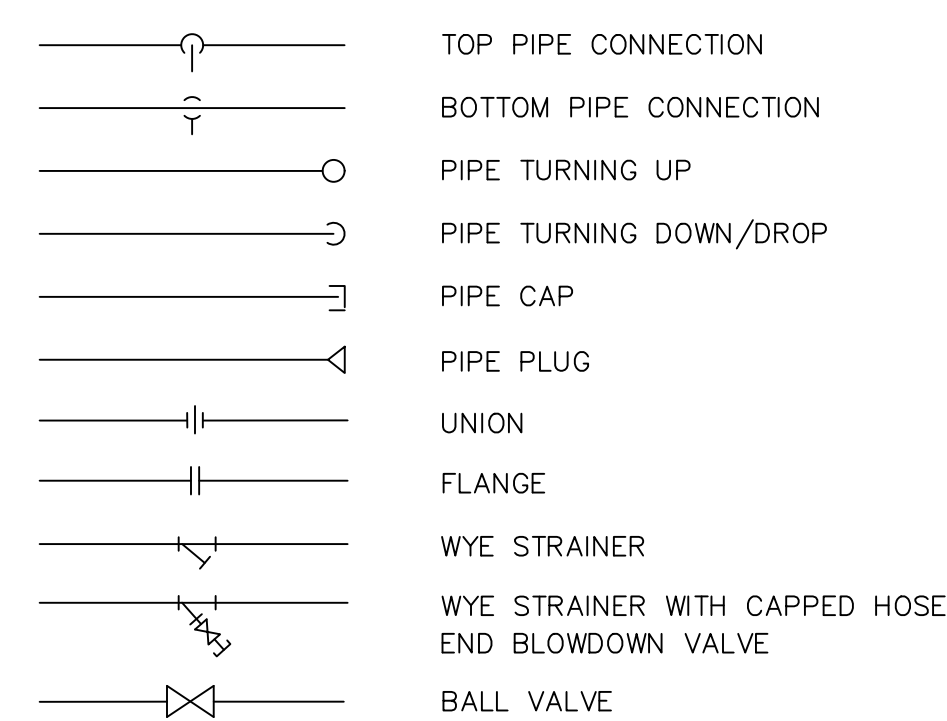


ABBREVIATIONS

ABV	ABOVE	FLR	FLOOR	OPD	OVERFLOW DRAIN/DECK DRAIN
AD	AREA DRAIN	FPM	FEET PER MINUTE	OPNG	OVER PRESSURE DEVICE
AFF	ABOVE FINISHED FLOOR	FPS	FEET PER SECOND	P	PUMP
AHJ	AUTHORITY HAVING JURISDICTION	FS	FLOOR SINK	PD	PRESSURE DROP, PLANTER DRAIN
BFF	BELOW FINISHED FLOOR	FT	FEET	POC	POINT OF CONNECTION
BFP	BACKFLOW PREVENTER	FU	FIXTURE UNITS	PRV	PRESSURE REDUCING VALVE
BOH	BACK OF HOUSE	G	GAS (LOW PRESSURE)	PS	PRESSURE RELIEF VALVE
BP	BOOSTER PUMP	GAL	GALLONS	PSD	PUMPED STORM DRAINAGE
BT	BATHTUB	GD	GARAGE DRAIN	PSG	POUNDS PER SQUARE INCH GAUGE
BTUH	BRITISH THERMAL UNIT PER HOUR	GM	GAS METER	PSO	PUMPED STORM DRAINAGE
CB	CATCH BASIN	GPM	GALLONS PER GALLON	PSS	PUMPED SANITARY SEWER
C	COMMON	GV	GATE VALVE	PSW	PUMPED SANITARY WASTE
CAP	CAPACITY	HP	HORSEPOWER	PW	PUMPED WASTE
CFM	CUBIC FEET PER MINUTE	HW	HOT WATER	RD	ROOF DRAIN
CD	CONDENSATE DRAIN	HD	HEAD	REF	REFERENCE
OFF	CAPPED FOR FUTURE	HDR	HUB DRAIN	RFP	REDUCED PRESSURE BACKFLOW PREVENTER
CFM	CUBIC FEET PER MINUTE	HDV	HOSE END DRAIN VALVE	RPM	REVOLUTIONS PER MINUTE
CI	CAST IRON	HORIZ	HORIZONTAL	S	SINK
CLG	CEILING, COOLING	HP	HORSEPOWER	SC	SCHEDULE
CO	CLOTHES WASHER	HPCW	HIGH PRESSURE COLD WATER	SCW	SOFTENED COLD WATER
CO	CLEANOUTS	HW	HOT WATER	SD	STORM DRAIN
COMB	COMBUSTION	HWC	HOT WATER RE-CIRCULATION	SEP	SEWAGE EJECTOR PUMP
CONT	CONTINUE, CONTROL	HWCP	HOT WATER CIRCULATION PUMP	SF	SQUARE FOOT
CONTR	CONTRACTOR	HWR	HOT WATER RETURN	SGSV	SEISMIC GAS SHUT-OFF VALVE
COTG	CLEANOUTS TO GRADE	ID	INDIRECT DRAIN, INSIDE DIAMETER	SH	SHOWER
CP	CIRCULATING PUMP	IE	INVERT ELEVATION	SO	STORM OVERFLOW
CP	CHECK VALVE	IHW	INDUSTRIAL HOT WATER	SP	STATIC PRESSURE/SUMP PUMP
CW	COLD WATER	IN	INCH	SR	SUDS RELIEF
D	DIAMETER	KS	KITCHEN SINK	SS	STAINLESS STEEL/SANITARY SEWER
DB	DRY BULB, DECIBEL	KW	KILOWATT	SSS	SIDE SANITARY SEWER
DF	DRINKING FOUNTAIN	L	LONG, LENGTH	STD	STANDARD
DFU	DRAIN FIXTURE UNITS	LAV	LAVATORY	SQ	SQUARE
DI	DUCTILE IRON	LB	POUND	TD	TRENCH DRAIN
DIM	DIMENSION	M	METER	TMV	THERMOSTATIC MIXING VALVE
DN	DOWN	MBS	THOUSAND BTU PER HOUR	TP	TRAP PRIMER
DS	DOWN SPOUT	MECH	MECHANICAL	TYP	TYPICAL
DWG	DRAWING	MCA	MIN. CIRCUIT AMPACITY	UH	UNIT HEATER
(E)	EXISTING	MCCP	MAX. OVER CURRENT PROTECTION	UON	UNLESS OTHERWISE NOTED
EFF	EFFICIENCY	MFG	MEDIUM PRESSURE GAS	UR	URNAL
ELEC	ELECTRIC	(N)	NEW	V	VENT
EQUIV	EQUIVALENT	NC	NORMALLY CLOSED	VTR	VENT THRU ROOF
EWC	ELECTRIC WATER COOLER	NO	NORMALLY OPEN	W	WASTE, WATT, WOE
EWH	ELECTRIC WATER HEATER	OD	OUTSIDE DIMENSION/DIAMETER	WC	WATER CLOSET
EXT	EXTERIOR, EXTERNAL			WCO	WALL CLEANOUTS
F	FAHRENHEIT			WHD	WALL HYDRANT
FCO	FLOOR CLEANOUTS			WM	WASHING MACHINE
FD	FLOOR DRAIN			WSFU	WATER SUPPLY FIXTURE UNITS
FDC	FIRE DEPARTMENT CONNECTION				
FF	FINISHED FLOOR				

DRAWING INDEX

DWG	DESCRIPTION	INCLUDED IN SET
POA.00	LEGEND, GENERAL NOTES, AND DRAWING INDEX	x
POA.01	PLUMBING NOTES AND TABLES	x
POA.02	PLUMBING CALCULATIONS	x
POA.03	PLUMBING SCHEDULES	x
P2A.00	UNDERSLAB WASTE & VENT PLAN	x
P2A.01	BASEMENT WASTE & VENT PLAN	x
P2A.02	LEVEL 1 WASTE & VENT PLAN	x
P2A.03	LEVEL 2 WASTE & VENT PLAN	x
P2A.04	LEVEL 3 WASTE & VENT PLAN	x
P2A.05	ROOF WASTE & VENT PLAN	x
P3A.01	BASEMENT PLUMBING SUPPLY PLAN	x
P3A.02	LEVEL 1 PLUMBING SUPPLY PLAN	x
P3A.03	LEVEL 2 PLUMBING SUPPLY PLAN	x
P3A.04	LEVEL 3 PLUMBING SUPPLY PLAN	x
P7A.00	DETAILS	x
P7A.01	DETAILS	x

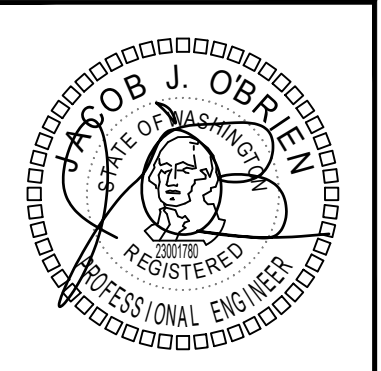

DRAWN:	DESIGNED:	CHECKED:	APPROVED:
JM	JM	RJ	JR

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A
 202 27TH AVE SE
 PUYALLUP, WA 98374

19401 40TH AVE W, SUITE 302
 LYNWOOD, WA 98036
 PHONE: (206) 364-3343

ROBISON ENGINEERING, INC.

DATE: 2/14/2024

SHEET TITLE:
 LEGEND GENERAL NOTES AND DRAWING INDEX

SHEET NO.
 POA.00

PLUMBING TABLES

PIPE INSULATION SCHEDULE

SERVICE	OPTION 1		OPTION 2		VAPOR RETARDER REQUIRED	NOTES
	MATERIAL	THICKNESS	MATERIAL	THICKNESS		
DOMESTIC COLD WATER, IRRIGATION WATER, CONDENSATE DRAINS, STORM DRAIN (IN CONDITIONED SPACE)	MINERAL-FIBER WITH JACKET	ALL SIZES: 1/2"	PVC/NBR	ALL SIZES: 3/8"	YES	12,13
DOMESTIC COLD WATER, IRRIGATION WATER, CONDENSATE DRAINS, WASTE (OUTSIDE THE CONDITIONED SPACE)	MINERAL-FIBER WITH JACKET	(R-3) 1/2" PIPE: 1/2" ALL OTHER SIZES: 1"	PVC/NBR	(R-3) 1/2" PIPE: 1/2" ALL OTHER SIZES: 3/4"	YES	7,8,10
ROOF DRAIN BODIES	MINERAL-FIBER OR CELLULAR GLASS WITH JACKET	1"	PVC/NBR	1"	YES	12
DOMESTIC HOT WATER AND RECIRCULATED HOT WATER (RESIDENTIAL)	MINERAL-FIBER WITH JACKET	(R-3) 1/2" PIPE: 1/2" ALL OTHER SIZES: 1"	PVC/NBR	(R-3) 1/2" PIPE: 1/2" ALL OTHER SIZES: 3/4"	NO	2,10
DOMESTIC HOT WATER AND RECIRCULATED HOT WATER (NONRESIDENTIAL)	MINERAL-FIBER WITH JACKET	1/2"-1 1/4" PIPE: 1" 1 1/2"-4" PIPE: 1.5"	PVC/NBR	1/2"-1 1/4" PIPE: 1" 1 1/2"-4" PIPE: 1.5"	NO	3,9
EXPOSED SANITARY DRAINS AND DOMESTIC WATER SUPPLIES AND STOPS FOR ADA FIXTURES.	TRUEBRO LAV-GUARD	N/A	N/A	N/A	NO	11

NOTES:

1. PIPING INSULATION EXPOSED TO THE WEATHER SHALL BE PROTECTED FROM DAMAGE. CONTRACTOR SHALL PROVIDE SHIELDING FROM SOLAR RADIATION THAT CAN CAUSE DEGRADATION OF THE MATERIAL. ADHESIVE TAPE SHALL NOT BE PERMITTED.
2. PER 2019 CEC SECTION R403.5.3 (RESIDENTIAL) INSULATION FOR HOT WATER PIPE SHALL HAVE A MINIMUM R-VALUE OF R-3.
3. PIPING FROM WATER HEATER TO THE TERMINATION OF HEATED WATER SUPPLY PIPE SHALL BE INSULATED IN ACCORDANCE WITH TABLE C403.2.9.
4. ON BOTH THE INLET AND OUTLET PIPING OF A STORAGE HOT WATER HEATER, THE FIRST 8 FEET OF PIPING OR PIPING FROM WATER HEATER TO HEAT TRAP SHALL BE INSULATED.
5. HEAT TRACED PIPING SHALL BE INSULATED IN THE SAME MANNER AS NON HEAT TRACED PIPING OR PER THE HEAT TRACE MANUFACTURER'S INSTRUCTIONS.
6. TUBULAR PIPING INSULATION SHALL NOT BE REQUIRED FOR THE FOLLOWING:
 - 6.1. THE TUBING FROM THE CONNECTION AT THE TERMINATION OF THE FIXTURE SUPPLY PIPING TO A PLUMBING FIXTURE OR PLUMBING APPLIANCE.
 - 6.2. VALVES, PUMPS, STRAINERS, AND THREADED UNIONS IN PIPING THAT IS 1 INCH OR LESS IN NOMINAL DIAMETER.
 - 6.3. PIPING FROM USER-CONTROLLED SHOWER AND BATH MIXING VALVES TO THE WATER OUTLETS.
 - 6.4. COLD WATER PIPING OF A DEMAND RECIRCULATION WATER SYSTEM.
 - 6.5. TUBING FROM A HOT DRINKING-WATER HEATING UNIT TO THE WATER OUTLET.
 - 6.6. PIPING AT LOCATIONS WHERE A VERTICAL SUPPORT OF THE PIPING IS INSTALLED.
 - 6.7. PIPING SURROUNDED BY BUILDING INSULATION WITH A THERMAL RESISTANCE (R-VALUE) OF NOT LESS THAN R-3.
 - 6.8. HOT WATER PIPING THAT IS PART OF THE FINAL PIPE RUN TO THE PLUMBING FIXTURE AND IS NOT PART OF THE HEATED-WATER CIRCULATION SYSTEM CIRCULATION PATH IS NOT REQUIRED TO MEET THE MINIMUM INSULATION REQUIREMENTS OF C404.6.
7. PER 2018 UPC SECTION 312.6 NO WATER, SOIL, OR WASTE PIPE SHALL BE INSTALLED OR PERMITTED OUTSIDE OF A BUILDING, IN ATTICS OR CRAWL SPACES, OR IN AN EXTERIOR WALL UNLESS, WHERE NECESSARY, ADEQUATE PROVISION IS MADE TO PROTECT SUCH PIPE FROM FREEZING. ALL HOT AND COLD WATER PIPES OUTSIDE THE CONDITIONED SPACE SHALL BE PROVIDED WITH INSULATION WITH A MINIMUM R-VALUE OF R-3.
8. HEAT TRACING SHALL BE PROVIDED FOR COLD WATER AND IRRIGATION WATER IN UNCONDITIONED SPACES. CONTACT ENGINEERING IF NECESSARY. PER 2019 CEC SECTION C403.12.3 FREEZE PROTECTION SYSTEMS, SUCH AS HEAT TRACING OF OUTDOOR PIPING, SHALL INCLUDE AUTOMATIC CONTROLS CONFIGURED TO SHUT OFF THE SYSTEMS WHEN OUTDOOR AIR TEMPERATURES ARE ABOVE 40°F.
9. PER 2019 CEC TABLE C403.2.9 INSULATION FOR HOT WATER AND HOT WATER RECIRCULATION SHALL HAVE A THERMAL CONDUCTIVITY OF 0.21-0.28 (BTU-IN/H-F-T) AT OPERATING TEMPERATURE.
10. INSULATION R-VALUE SHALL MEET THE MINIMUM REQUIREMENT. THICKNESS IS BASED ON GRAINGER SAMPLE DATA FOR K-FLEX(PVC/NBR) AND OWENS CORNING(FIBER GLASS).
11. ALL ADA P-TRAPPS, HOT WATER SUPPLY TUBING, AND SHUT-OFF COCKS SHALL BE PROTECTED WITH APPROVED COVERS TO PREVENT SCALDING.
12. REQUIRED BY ENGINEERING BASED ON BEST PRACTICE.
13. INSULATION IS NOT REQUIRED ON PLASTIC COLD WATER PIPING.

HANGER SPACING FOR WATER PIPING		
ALL SUSPENDED WATER SUPPLY PIPE SHALL BE SUPPORTED AS FOLLOWS PER 2018 UPC TABLE 313.3:		
PIPE SIZE	MAX. HORIZONTAL SPACING	MAX. VERTICAL SPACING
COPPER PIPE $\leq 1/2"$	6 FT.	10 FT.
COPPER PIPE $> 2"$	10 FT.	10 FT.
COPPER TUBING $\leq 1/2"$	6 FT.	10 FT.
COPPER TUBING $> 2"$	10 FT.	10 FT.
CPVC $\leq 1"$	3 FT.	10 FT.
CPVC $> 1 1/2"$	4 FT.	10 FT.

HANGER SPACING FOR WASTE AND VENT PIPING		
ALL SUSPENDED SANITARY AND VENT PIPE SHALL BE SUPPORTED AS FOLLOWS PER 2018 UPC TABLE 313.3:		
PIPE TYPE	MAX. HORIZ. SPACING	MAX. VERT. SPACING
ABS	4 FT.	10 FT.
PVC (TYPE DWV)	4 FT.	10 FT.
CAST-IRON HUBLESS*	EVERY 15 FT.	
*CAST-IRON OVER 4" SHALL BE SUPPORTED AT EVERY JOINT		

PLUMBING FIXTURE FLOW RATES PER 2018 UPC CH. 4

FIXTURE TYPE	FLOW RATE	NOTES
SHOWERHEADS	1.8 GPM @ 80 PSI	
LAVATORY FAUCETS, RESIDENTIAL	1.2 GPM @ 60 PSI	1
LAVATORY FAUCETS, NON-RESIDENTIAL	0.5 GPM @ 60 PSI	2
KITCHEN FAUCETS	1.8 GPM @ 60 PSI	3
GRAVITY TANK-TYPE WATER CLOSETS	1.28 GALLONS/FLUSH	4
FLUSHOMETER TANK WATER CLOSETS	1.28 GALLONS/FLUSH	4
FLUSHOMETER VALVE WATER CLOSETS	1.28 GALLONS/FLUSH	4
ELECTROMECHANICAL HYDRAULIC WATER CLOSETS	1.28 GALLONS/FLUSH	4
URINALS	0.5 GALLONS/FLUSH	

NOTES:

1. LAVATORY FAUCETS SHALL NOT HAVE A FLOW RATE LESS THAN 0.8 GPM AT 20 PSI.
2. WHERE COMPLYING FAUCETS ARE UNAVAILABLE, AERATORS RATED AT 0.35 GPM OR OTHER MEANS MAY BE USED TO ACHIEVE REDUCTION.
3. KITCHEN FAUCETS MAY TEMPORARILY INCREASE FLOW ABOVE THE MAXIMUM RATE, BUT NOT ABOVE 2.2 GPM @ 60 PSI AND MUST DEFAULT TO A MAXIMUM FLOW RATE OF 1.8 GPM @ 60 PSI.
4. INCLUDES SINGLE AND DUAL FLUSH WATER CLOSETS WITH AN EFFECTIVE FLUSH OF 1.6 GALLONS OR LESS. SINGLE FLUSH TOILETS - THE EFFECTIVE FLUSH VOLUME SHALL NOT EXCEED 1.6 GALLONS. THE EFFECTIVE FLUSH VOLUME IS THE AVERAGE FLUSH VOLUME WHEN TESTED IN ACCORDANCE WITH ASME A112.19.2 DUAL FLUSH TOILETS - THE EFFECTIVE FLUSH VOLUME SHALL NOT EXCEED 1.6 GALLONS. THE EFFECTIVE FLUSH VOLUME IS DEFINED AS THE COMPOSITE, AVERAGE FLUSH VOLUME OF TWO REDUCED FLUSHES AND ONE FULL FLUSH. FLUSH VOLUMES WILL BE TESTED IN ACCORDANCE WITH ASME A112.19.2 AND ASME A112.19.14.

NOTE TO CONTRACTOR

DRAWINGS ARE DIAGRAMMATIC, SHOWING THE GENERAL LOCATION, TYPE, LAYOUT, AND EQUIPMENT REQUIRED. THE DRAWINGS SHALL NOT BE SCALED FOR EXACT MEASUREMENT. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS. REFER TO MANUFACTURER'S STANDARD INSTALLATION DRAWINGS FOR EQUIPMENT CONNECTIONS AND INSTALLATION REQUIREMENTS. PROVIDE DUCTWORK, CONNECTIONS, ACCESSORIES, OFFSETS, AND MATERIALS NECESSARY FOR A COMPLETE SYSTEM.

CONTRACTOR SUBSTITUTIONS & REVISIONS

PLEASE SUBMIT PROPOSALS FOR SUBSTITUTIONS OR REVISIONS FOR REVIEW AND APPROVAL PRIOR TO ORDERING MATERIAL OR DOING WORK. FOR EQUIPMENT THAT IS SCHEDULED BY MANUFACTURER'S NAME AND CATALOG DESIGNATIONS, THE MANUFACTURER'S PUBLISHED DATA AND/OR SPECIFICATION FOR THAT ITEM ARE CONSIDERED PART OF SPECIFICATION. ENGINEERING COSTS FOR REVISING MEP PLANS SHALL BE ADDRESSED IN THE COST ANALYSIS OF THE SUBSTITUTION PROPOSAL. CONTRACTOR TO COORDINATE WITH ENGINEER AND DETERMINE ASSOCIATED DESIGN AND PERMITTING COSTS. CONTRACTOR SHALL BE RESPONSIBLE FOR OTHER COSTS ASSOCIATED WITH UNFORESEEN ISSUES RESULTING FROM SUBSTITUTIONS OR REVISIONS.

PRE-CONSTRUCTION MEETING NOTES

CONTRACTORS SHALL ATTEND A PRE-CONSTRUCTION MEETING WITH THE ENGINEER FOR THE PURPOSE OF REVIEWING THE WORK PRIOR TO ORDERING ANY EQUIPMENT OR PERFORMING ANY WORK. THE MEETING SHALL BE LOCATED AT THE PROJECT SITE ON A DATE AND TIME TO BE MUTUALLY AGREED. THE MEETING WILL BE A WORKING SESSION. THE MEETING WILL BE FACILITATED BY THE ENGINEER AND THE AGENDA WILL INCLUDE A DETAILED REVIEW OF THE PLANS AND SPECIFICATIONS, CROSS CHECK WITH OTHER TRADES FOR COORDINATION ISSUES, REVIEW OF PROPOSED PRODUCTS, REVIEW OF PLANNED MEANS AND METHODS, AND ON-SITE INVESTIGATION OF FIELD CONDITIONS RELATIVE TO EXISTING CONDITIONS THAT COULD AFFECT THE WORK. PERSONS ATTENDING THE MEETING SHALL BE KNOWLEDGEABLE OF THE PROJECT AND SHALL BE THE SPECIFIC PERSONS INTENDED TO CONTINUE WITH THE PROJECT THROUGH TO COMPLETION. IF REQUIRED, REVISED PLANS WILL BE ISSUED THROUGH OFFICIAL CHANNELS. CHANGES IN THE BID PRICE WILL BE DISCUSSED, BUT NO CHANGE ORDERS WILL BE ISSUED UNLESS PROCESSED THROUGH OFFICIAL CHANNELS. IT SHALL BE UNDERSTOOD THAT THE ENGINEER HAS NO AUTHORITY TO ISSUE CHANGE ORDERS.

THE FOLLOWING TRADES SHALL BE REPRESENTED FOR THE MINIMUM TIME INDICATED:

MECHANICAL SHEET METAL	4 HOURS
PLUMBING/PIPING	4 HOURS
ELECTRICAL	4 HOURS
SPRINKLER	2 HOURS
GENERAL CONTRACTOR	ALL SESSIONS


PLUMBING NOTES

1. CONNECTIONS: PROVIDE PLUMBING FIXTURE CONNECTIONS TO BUILDING WASTE, VENT, COLD WATER, AND HOT WATER SYSTEM IN ACCORDANCE WITH DRAWINGS, MANUFACTURER'S RECOMMENDATIONS, AND LOCAL CODES. CONNECT TO EACH FIXTURE, EQUIPMENT, ETC. WITH ALL ACCESSORIES, VALVES, VACUUM BREAKERS, REGULATORS, UNIONS, ETC. AS REQUIRED AND AS RECOMMENDED BY THE MANUFACTURERS. REFER TO PLUMBING FIXTURE CONNECTION SCHEDULE ON PLANS.
2. HOT AND COLD: WATER PIPING CONNECTION TO EACH FIXTURE SHALL BE COLD WATER ON THE RIGHT HAND SIDE AND HOT WATER ON THE LEFT HAND SIDE.
3. HOT WATER: NON-CIRCULATING HOT WATER PIPE SHALL NOT EXCEED 10' UNLESS OTHERWISE SHOWN ON DRAWINGS.
4. VENT STACKS: COORDINATE VENT STACK WITH HVAC EQUIPMENT TO MAINTAIN MINIMUM 10' CLEARANCE FROM OUTSIDE AIR INTAKES.
5. CLEANOUTS: PROVIDE CLEANOUTS PER CURRENT UPC AND AS REQUIRED BY LOCAL JURISDICTIONS. CLEANOUTS SHALL BE LOCATED IN WALLS/FLOORS WHERE THEY ARE NOT HIGHLY VISIBLE. FLOOR CLEANOUTS IN CARPETED AREAS TO BE FITTED WITH CARPET INSERTS. LOCATIONS SHALL BE SUBMITTED TO ARCHITECT FOR APPROVAL. NOTE: NOT ALL CLEANOUTS ARE SHOWN ON THE PLUMBING DRAWINGS.
6. SUDS RELIEF: PROVIDE SUDS RELIEF IN ACCORDANCE WITH 2018 UPC SECTION 711.0, STATE AND LOCAL CODES.
7. SHUT-OFFS: PROVIDE 1/4 TURN BALL VALVE ANGLE STOP SHUT-OFF VALVES AND BRAIDED STAINLESS STEEL FLEX CONNECTORS AT HOT AND COLD WATER SUPPLY TO EACH FIXTURE. EXCEPTION: PROVIDE SCREWDRIVER STOPS AT BATH/SHOWERS.
8. TUB SPOUTS SHALL BE THREADED (NO PUSH-ON FITTINGS).
9. TRAP ARMS: PROVIDE TRAP ARMS SUCH THAT THE MAXIMUM LENGTH WILL NOT EXCEED CODE REQUIREMENTS.
10. ADA INSULATION: AT PLUMBING PIPING EXPOSED UNDER LAVATORIES, INSULATE THE EXPOSED PIPING AND TRAPS WITH PRODUCT SPECIFICALLY DESIGNED FOR THIS APPLICATION MEETING ADA REQUIREMENTS. PROVIDE HANDI-LAV GUARD OR EQUIVALENT. OFFSET P-TRAPPS TO CLEAR WHEELCHAIR ACCESS.
11. GAS EQUIPMENT: GAS EQUIPMENT SHALL BE INSTALLED PER EQUIPMENT LISTINGS, APPLICABLE SFGC, SPC, LOCAL CODES & NFPA STANDARDS.
12. GAS CONNECTIONS: INSTALL FLEXIBLE QUICK DISCONNECT ASSEMBLIES FOR ALL GAS FIRED KITCHEN EQUIPMENT PER APPLICABLE SFGC, SPC, LOCAL CODES & NFPA STANDARDS. PROVIDE LOCKABLE GAS SHUT-OFF VALVES FOR FIREPLACES & BBQS IN UNATTENDED PUBLIC LOCATIONS IN THE BUILDING.
13. GAS PIPING CONNECTIONS TO WATER HEATERS, BOILERS AND FURNACES SHALL HAVE DIRT LEGS AND UNIONS PROVIDED ON APPLIANCE SIDE OF SHUTOFF VALVE.
14. GAS PIPING INSTALLATION: STEEL OR MALLEABLE IRON FUEL LINES 2" OR SMALLER SHALL BE ASSEMBLED USING THREAD SEALANT SUITABLE FOR NATURAL GAS. GAS PIPING LARGER THAN 2" SHALL HAVE WELDED FITTINGS.
15. GAS PIPING UNDERGROUND: WHERE INSTALLED BELOW GRADE THROUGH THE OUTER FOUNDATION OR BASEMENT WALL OF A BUILDING, SHALL BE ENCASED IN A PROTECTIVE PIPE SLEEVE. THE ANNULAR SPACE BETWEEN THE GAS PIPING AND THE SLEEVE SHALL BE SEALED.
16. GAS PIPING ABOVE GROUND: WHERE PASSING THROUGH AN OUTSIDE WALL, GAS PIPING SHALL BE PROTECTED AGAINST CORROSION BY COATING OR WRAPPING WITH AN INERT MATERIAL. WHERE PIPING IS ENCASED IN A PROTECTIVE PIPE SLEEVE, THE ANNULAR SPACE BETWEEN THE PIPING AND THE SLEEVE SHALL BE SEALED.
17. GAS PIPE SUPPORT: FUEL LINES SHALL BE SUPPORTED OR STRAPPED, AND SHALL BE PLUMB AND SQUARE.
18. GAS PIPING ON ROOFTOPS SHALL BE SUPPORTED AND ANCHORED TO THE ROOF.
19. GAS PIPING SHALL NOT BE BURIED UNDER A BUILDING, SLAB OR OTHER STRUCTURE.
20. GAS PIPING PROTECTIVE COATING: PAINT ALL EXTERIOR EXPOSED GAS PIPING WITH TWO COATS OF RUST INHIBITIVE PAINT. COLOR: GRAY.
21. WATER HAMMER ARRESTORS: PROVIDE AT THE END OF HOT AND COLD WATER LINES SERVING TWO OR MORE FIXTURES; SIZE IN ACCORDANCE WITH PLUMBING AND DRAINAGE INSTITUTE (PDI) REQUIREMENTS. WATER HAMMER ARRESTORS ARE REQUIRED FOR QUICK CLOSING VALVES, SUCH AS LAUNDRY WASHERS, FLUSH VALVES (PUBLIC TOILETS), ETC.
22. TRAP PRIMERS AS SPECIFIED: PROVIDE TRAP PRIMERS AND PIPING FOR FLOOR DRAINS, FLOOR SINKS, AREA DRAINS & HUB DRAINS. ARRANGE PIPING TO ACHIEVE EQUAL FLOW TO EACH DRAIN AND FLOOR SINK FOR TRAP PRIMERS SERVING MULTIPLE DRAINS AND FLOOR SINKS. COORDINATE EXACT LOCATIONS WITH ARCHITECT & ELECTRICAL ENGINEER.
23. P-TRAPPS: ALL EXPOSED P-TRAPPS SHALL BE CHROME-PLATED BRASS. P-TRAPPS SERVING HANDICAPPED COUNTER TOP LAVATORIES SHALL BE INSULATED.
24. THROUGHOUT THE PROJECT PROVIDE BALL VALVES. GATE VALVES SHALL NOT BE USED. NO EXCEPTIONS.
25. HOT WATER RECIRCULATING BALANCING VALVES SHOULD BE BELL & GOSSETT CIRCUIT SETTER (WATTS OR EQUAL) WITH INTEGRAL READOUT PORTS, ADJUSTMENT KNOB, DRAIN CONNECTION, AND POSITIVE SHUTOFF.
26. DISASSEMBLY PROVISIONS: PROVIDE UNIONS OR FLANGES AT PIPING CONNECTIONS TO EQUIPMENT, COILS, TRAPS, CONTROL VALVES, AND OTHER COMPONENTS TO ALLOW DISASSEMBLY FOR MAINTENANCE.
27. REDUCERS: PROVIDE AS REQUIRED FROM LINE PIPE SIZE TO EQUIPMENT, TRAP, COIL, AND CONTROL VALVE CONNECTION SIZES.
28. VALVE TAGS: PROVIDE VALVE TAGS PER SPECIFICATIONS TO IDENTIFY VALVE AND THE AREA IT SERVES.
29. OFFSETS: PROVIDE FOR BRANCH LINES TO EQUIPMENT.
30. ALL TEMPERATURE MIXING VALVES SHALL COMPLY WITH ASSE-1070 SAFETY STANDARDS.
31. PROVIDE PIPE MARKER WITH DIRECTION OF FLOW. LABEL "NON-POTABLE WATER DO NOT DRINK" CLEARLY ON NON-POTABLE WATER PIPING.
32. PROVIDE EXPANSION LOOPS/EXPANSION JOINTS IN PIPING PER 2018 UPC TABLE 313.3 AND MANUFACTURER INSTALLATION INSTRUCTIONS.
33. PROVIDE APPROVED PIPE HANGERS & PIPE SUPPORTS IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS AND 2018 UPC TABLES 313.3 & 313.6. SUBMIT FOR APPROVAL.
34. DIELECTRIC UNIONS: PROVIDE AT CONNECTIONS OF DISSIMILAR PIPE.
35. REFRIGERANT PIPING: PROVIDE SIZING & INSTALLATION IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
36. CONDENSATE DRAIN: PROVIDE A P-TRAP FOR EACH HVAC UNIT CONDENSATE PAN WITH PLUG TEES FOR CLEANING. CONDENSATE DRAINS SHALL BE DISCHARGED TO AN INDIRECT WASTE OR OUTSIDE.
37. PIPING & EQUIPMENT SUPPORTS/HANGERS & SEISMIC RESTRAINTS TO BE DESIGNED BY DESIGN BUILT CONTRACTOR.
38. IF NEEDED, PROVIDE VACUUM BREAKERS AT ALL HOSE BIBBS.
39. FLOOR DRAINS OR SIMILAR TRAPS DIRECTLY CONNECTED TO THE DRAINAGE AND SUBJECT TO INFREQUENT USE SHALL BE PROVIDED WITH AN APPROVED AUTOMATIC MEANS OF MAINTAINING THEIR WATER SEALS IN ACCORDANCE WITH 2018 UPC 1007.0.
40. INSULATION MATERIAL SHALL MEET CITY OF FERDALE QUALITY STANDARDS.
41. ALL PIPING AND DUCTWORK SHALL BE INSULATED CONSISTENT WITH THE 2018 WASHINGTON STATE ENERGY CODE.
42. BUILDING DRAIN AND VENT PIPING MATERIALS SHALL COMPLY WITH 2018 UPC 701.0 AND 903.0.
43. ALL SANITARY SYSTEM MATERIAL SHALL BE LISTED BY AN APPROVED LISTING AGENCY.
44. ALL STORAGE WATER HEATING EQUIPMENT SHALL BE PROVIDED WITH AN APPROVED, LISTED EXPANSION TANK OR OTHER DEVICE DESIGNED FOR INTERMITTENT OPERATION FOR THERMAL EXPANSION CONTROL PER 2018 UPC 608.3.
45. WATER HEATERS SHALL BE ANCHORED OR STRAPPED TO RESIST HORIZONTAL DISPLACEMENTS DUE TO SEISMIC MOTION PER 2018 UPC 507.2.
46. MATERIAL EXPOSED WITHIN A DUCT OR PLENUM SHALL COMPLY WITH 2018 IMC 602.2.1.
47. HVAC EQUIPMENT AND WATER HEATERS SHALL COMPLY WITH 2018 IMC CHAPTER 3.
48. BOILERS SHALL COMPLY WITH ALL THE REQUIREMENTS OF 2018 IMC CHAPTER 10.
49. PROVIDE EXPANSION TANKS FOR BOILERS PER 2018 IMC SECTION 1009.0.
50. SHOWERS AND TUB/SOWER COMBINATIONS SHALL BE PROVIDED WITH MIXING VALVES PER 2018 UPC 408.0.
51. PLUMBING FIXTURES AND FITTINGS SHALL COMPLY WITH CITY OF FERDALE WATER CONSERVATION STANDARDS.
52. CONTRACTOR SHALL PROVIDE FIRESTOPPING AT PENETRATIONS AS NECESSARY TO RETAIN THE FIRE RATING OF ALL ASSEMBLIES. ALL WORK SHALL BE IN COMPLIANCE WITH CODE REQUIREMENTS FOR THE BUILDING CONSTRUCTION TYPE.
53. ALL GARAGE DRAINS, TRASH ROOMS DRAINS & GARAGE TRENCH DRAINS SHALL BE TAKEN TO SAND/OIL INTERCEPTOR(S) BEFORE CONNECTING TO THE SANITARY SEWER SYSTEM.
54. PLUMBING CONTRACTOR SHALL PROVIDE REDUCED PRESSURE BACKFLOW PREVENTERS OR OTHER APPROVED BACKFLOW PREVENTION DEVICE WHERE REQUIRED BY HEALTH AUTHORITIES, FOOD SERVICE DRAWINGS, APPLIANCE MANUFACTURER INSTRUCTIONS AND BY CODE.
 - a. ICE MACHINES AND ICE MAKERS
 - b. CARBONATED BEVERAGE DISPENSING SYSTEMS
 - c. COFFEE BREWERS
 - d. ESPRESSO MACHINES
 - e. WATER FILTERS
 - f. STEAM OR HOT WATER BOILERS
 - g. IRRIGATION SYSTEM
 - h. FIRE PROTECTION SYSTEM
 - i. CHEMICAL TREATMENT SYSTEM
 - j. SOAP/CHEMICAL DISPENSER SYSTEM
 - k. COMMERCIAL WASHER

APPLICABLE CODES

THE FOLLOWING PROJECT DESIGN IS BASED ON THE FOLLOWING CODES:

- 2018 INTERNATIONAL BUILDING CODE (IBC)
- 2018 INTERNATIONAL MECHANICAL CODE (IMC)
- 2018 UNIVERSAL PLUMBING CODE (UPC)
- 2018 WASHINGTON STATE ENERGY CODE (WSEC) - COMMERCIAL PROVISIONS

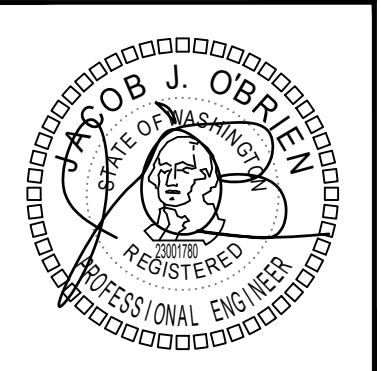

DRAWN:	JM
DESIGNED:	JM
CHECKED:	RJ
APPROVED:	JR

BRADLEY HEIGHT APARTMENTS - BUILDING A
 PROJECT: 202 27TH AVE SE PUYALLUP, WA 98374
 19401 40TH AVE SE, SUITE 302 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343
ROBISON ENGINEERING, INC.

DATE: 2/14/2024

SHEET TITLE:
PLUMBING NOTES AND TABLES


SHEET NO.
POA.01

PLUMBING CALCULATIONS

CALCULATIONS BASED ON 2018 UPC															
1 Bedroom Units (1 Bath)															
FIXTURE	FIXTURE UNITS								# OF FIXTURES PER UNIT	TOTAL QTY OF FIXTURES	TOTAL FIXTURE UNITS				
	TOTAL	CW	HW	WV	B	1	2	3			R	SERVICE	CW ONLY	HW ONLY	WV ONLY
WATER CLOSET	2.5	2.5	0	3	3	6	6	6	0	1	21	52.5	52.5	0	63
LAVATORY	1	0.75	0.75	1	3	6	6	6	0	1	21	21	15.75	15.75	21
BATHTUB	4	3	3	2	3	6	6	6	0	1	21	84	63	63	42
CLOTHES WASHER	4	3	3	3	3	6	6	6	0	1	21	84	63	63	63
KITCHEN SINK W/ DISHWASHER	3	2.25	2.25	2	3	6	6	6	0	1	21	63	47.25	47.25	42
TOTAL:											304.5	241.5	189	231	
2 Bedroom Unit (2 Bath)															
FIXTURE	FIXTURE UNITS								# OF FIXTURES PER UNIT	TOTAL QTY OF FIXTURES	TOTAL FIXTURE UNITS				
	TOTAL	CW	HW	WV	B	1	2	3			R	SERVICE	CW ONLY	HW ONLY	WV ONLY
WATER CLOSET	2.5	2.5	0	3	1	2	2	2	0	2	14	35	35	0	42
LAVATORY	1	0.75	0.75	1	1	2	2	2	0	2	14	14	10.5	10.5	14
BATHTUB	4	3	3	2	1	2	2	2	0	2	14	56	42	42	28
CLOTHES WASHER	4	3	3	3	1	2	2	2	0	1	7	28	21	21	21
KITCHEN SINK W/ DISHWASHER	3	2.25	2.25	2	1	2	2	2	0	1	7	21	15.75	15.75	14
TOTAL:											154	124.25	89.25	119	
Public Fixtures															
FIXTURE	FIXTURE UNITS								# OF FIXTURES PER UNIT	TOTAL QTY OF FIXTURES	TOTAL FIXTURE UNITS				
	TOTAL	CW	HW	WV	B	1	2	3			R	SERVICE	CW ONLY	HW ONLY	WV ONLY
HOSE BIB	2.5/1	2.5/1	0	0	2	0	0	0	0	0	2	3.5	3.5	0	0
4" FLOOR DRAIN	0	0	0	8	1	0	0	0	0	0	1	0	0	0	8
TOTAL:											3.5	3.5	0	8	
TOTAL FIXTURE UNITS:											462	369.25	278.25	358	
PEAK FLOW:											117.4 GPM				
SUPPLY												3"	6"		
REQUIRED SERVICE SIZE IN BUILDING:												3"	6"		

BRADLEY HEIGHTS APARTMENTS - WATER SUPPLY PRESSURE CALCULATIONS ARE BASED ON 2018 UPC APPENDIX A	
FROM STREET TO RPBP	
STREET PRESSURE, PSI	75
MINIMUM STREET PRESSURE, PSI	75
<i>ASSUME +/- 5 PSI FLUCTUATION</i>	
EQUIPMENT LOSSES, PSI	
WATER METER LOSS	4
BACKFLOW PREVENTER	10
SITE SERVICE LINE (ESTIMATE)	
PIPING SYSTEM LENGTH, FEET	50
FITTING ALLOWANCE, FEET	12.5
<i>FROM STREET TO RPBP</i>	
ZONE FRICTION LOSS FACTOR, PSI/100'	7.0
TOTAL ZONE FRICTION LOSS, PSI	4.38
MINIMUM PRESSURE AT RPBP, PSI	56.63
FROM RPBP TO FURTHEST APARTMENT UNIT	
MINIMUM PRESSURE AT END PREVIOUS ZONE, PSI	56.6
EQUIPMENT LOSSES, PSI	
THERMOSTATIC MIXING VALVE LOSS	4
STATIC HEAD, PSI	
TOTAL ELEVATION GAIN, FT	30
PIPING FRICTION LOSSES	
PIPING SYSTEM LENGTH, FEET	150
FITTING ALLOWANCE, FEET	22.5
ZONE FRICTION LOSS FACTOR, PSI/100'	7.0
TOTAL ZONE FRICTION LOSS, PSI	12.075
MINIMUM PRESSURE AT FURTHEST APARTMENT UNIT, PSI	27.6
FROM FURTHEST APARTMENT UNIT TO FURTHEST FIXTURE	
MINIMUM PRESSURE AT FURTHEST APARTMENT UNIT, PSI	27.6
PIPING FRICTION LOSSES	
RISER TO MANIFOLD, FEET	4
FITTING ALLOWANCE, FEET	6
<i>FROM MANIFOLD TO FURTHEST FIXTURE</i>	
ZONE FRICTION LOSS FACTOR, PSI/100'	14.0
TOTAL ZONE FRICTION LOSS, PSI	6.3
MINIMUM PRESSURE AT FURTHEST FIXTURE, PSI	21.3

NO.	DATE	DESCRIPTION	REVISIONS



DRAWN: JM	DESIGNED: JM	CHECKED: RJ	APPROVED: JR
-----------	--------------	-------------	--------------

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A
 202 27TH AVE SE
 PUYALLUP, WA 98374
ROBISON ENGINEERING, INC.
 19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343

DATE: 2/14/2024

SHEET TITLE:
PLUMBING CALCULATIONS

SHEET NO.
POA.02

PLUMBING SCHEDULES

PIPE MATERIALS

PIPE TYPE	MATERIAL	JOINT	NOTES
WATER DISTRIBUTION PIPING	COPPER, TYPE L.	SOLDERED	2
APARTMENT WATER PIPING	PEX-A	EXPANSION OR PUSH-FIT FITTINGS	2
WASTE AND VENT PIPING	SCHEDULE 40 SOLID CORE PVC	SOLVENT CEMENT	1,3
CONDENSATE DRAIN PIPING	COPPER, TYPE M.	SOLDERED OR PROPPRESS FITTINGS	

NOTES:

1. ALL SANITARY SYSTEM MATERIALS SHALL BE LISTED BY AN APPROVED LISTING AGENCY.
2. PROVIDE THERMAL EXPANSION LOOPS FOR ALL WATER PIPING IN ACCORDANCE WITH MANUFACTURER INSTRUCTIONS.
3. PROVIDE CAST IRON PIPING FOR WASTE DISCHARGE EXCEEDING 110 DEGREES FAHRENHEIT.

PIPE SIZING SCHEDULE - COPPER TYPE L AT 7.0 PSI/100 FEET

PIPE SIZE	COLD WATER, FLUSH TANK			HOT WATER			COLD WATER, FLUSH VALVE		
	FIXTURE UNITS	FLOW, GPM	VELOCITY, FPS	FIXTURE UNITS	FLOW, GPM	VELOCITY, FPS	FIXTURE UNITS	FLOW, GPM	VELOCITY, FPS
1/2"	3.0	2.8	4.0	3.0	2.8	4.0	---	---	---
3/4"	9.0	7.5	5.2	8.5	7.0	4.9	---	---	---
1"	22.0	16.0	6.4	16.0	12.2	5.0	---	---	---
1-1/4"	45.0	27.0	7.3	27.0	18.5	5.0	9	27	7.3
1-1/2"	100.0	43.0	8.0	43.0	26.0	5.0	30	42.5	8
2"	230.0	75.0	8.0	112.0	45.0	5.0	125.0	74.0	8.0
2-1/2"	440.0	116.0	8.0	215.0	72.0	5.0	340.0	116.0	8.0
3"	750.0	160.0	8.0	350.0	100.0	5.0	680.0	160.0	8.0
4"	1600.0	280.0	8.0	800.0	175.0	5.0	1600.0	280.0	8.0
6"	5250.0	650.0	8.0	2750.0	400.0	5.0	5250.0	650.0	8.0

PIPE SIZING SCHEDULE - PEX AT 14.0 PSI/100 FEET

PIPE SIZE	COLD WATER, FLUSH TANK			HOT WATER			COLD WATER, FLUSH VALVE		
	FIXTURE UNITS	FLOW, GPM	VELOCITY, FPS	FIXTURE UNITS	FLOW, GPM	VELOCITY, FPS	FIXTURE UNITS	FLOW, GPM	VELOCITY, FPS
1/2"	3.0	3.0	5.5	3.0	3.4	6.1	---	---	---
3/4"	9.0	7.8	7.1	11.0	8.5	7.7	1.0	7.8	7.1
1"	21.0	15.3	8.4	20.0	14.6	8.0	2.0	15.3	8.4
1-1/4"	44.0	26.1	9.6	33.0	21.8	8.0	9.0	26.1	9.6
1-1/2"	77.0	37.9	10.0	54.0	30.3	8.0	24.0	37.9	10.0
2"	199.0	65.0	10.0	134.0	52.0	8.0	91.0	65.0	10.0
2-1/2"	375.0	99.0	10.0	270.0	79.2	8.0	239.0	99.0	10.0
3"	589.0	140.8	10.0	443.0	112.6	8.0	494.0	140.8	10.0

REDUCED PRESSURE BACKFLOW ASSEMBLY

EQUIP NO.	QTY	SERVICE	INLET/OUTLET SIZE	BASIS OF DESIGN	NOTES
RPBP-1	1	DOMESTIC WATER	3"	ZURN WILKINS 375	1,2

NOTES:

1. INSTALL IN ACCORDANCE WITH MANUFACTURER INSTRUCTIONS.
2. ALL DOMESTIC WATER EQUIPMENT SHALL BE NSF-61 LISTED.

HYBRID ELECTRIC HEAT PUMP WATER HEATER

EQUIP NO.	SERVICE	UNIFORM ENERGY FACTOR	GPH RECOVERY AT 90°F TR	STORAGE (GAL)	INLET/OUTLET CONNECTION	OPERATING WEIGHT (LBS)	ELECTRICAL	BASIS OF DESIGN	NOTES
HPWH-1	APARTMENT UNITS	4.00	27	80	3/4"	912	208V/1P/21A	RHEEM PROPH80	1,2,3,4

NOTES:

1. ELECTRICAL REQUIREMENTS ARE BASED ON NON-SIMULTANEOUS OPERATION.
2. FOR WATER HEATER PIPING DIAGRAM SEE DETAIL 1/P7.00.
3. ALL DOMESTIC WATER EQUIPMENT SHALL BE NSF-61 LISTED.
4. PROVIDE INLET AND OUTLET DUCTS FOR HEAT PUMP WATER HEATERS. SEE MECHANICAL DRAWINGS FOR ROUTING AND TERMINATION.



EXPANSION TANK

EQUIP NO.	SERVICE	CAPACITY GAL.	PRE-CHARGE PRESSURE, PSI	TANK SIZE		OPERATING WEIGHT, LBS	BASIS OF DESIGN	NOTES
				DIAMETER	HEIGHT			
ET-1	DOMESTIC HOT WATER	4.5	50	11	15	9	THERM-X-TROL ST-12	1

NOTES:

1. INSTALL PER MANUFACTURER'S RECOMMENDATIONS

NO.	DATE	DESCRIPTION	REVISIONS

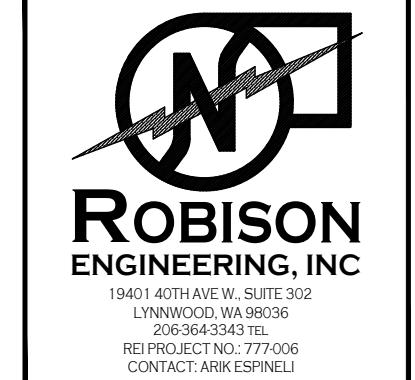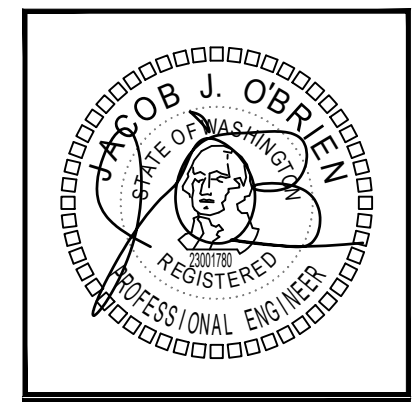

DRAWN:	DESIGNED:	CHECKED:	APPROVED:
JM	JM	RJ	JR


BRADLEY HEIGHT APARTMENTS - BUILDING A
 202 27TH AVE SE
 PUYALLUP, WA 98374

ROBISON ENGINEERING, INC.
 19401 40TH AVE W., SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343

DATE: 2/14/2024

SHEET TITLE:
PLUMBING SCHEDULES

SHEET NO.
POA.03

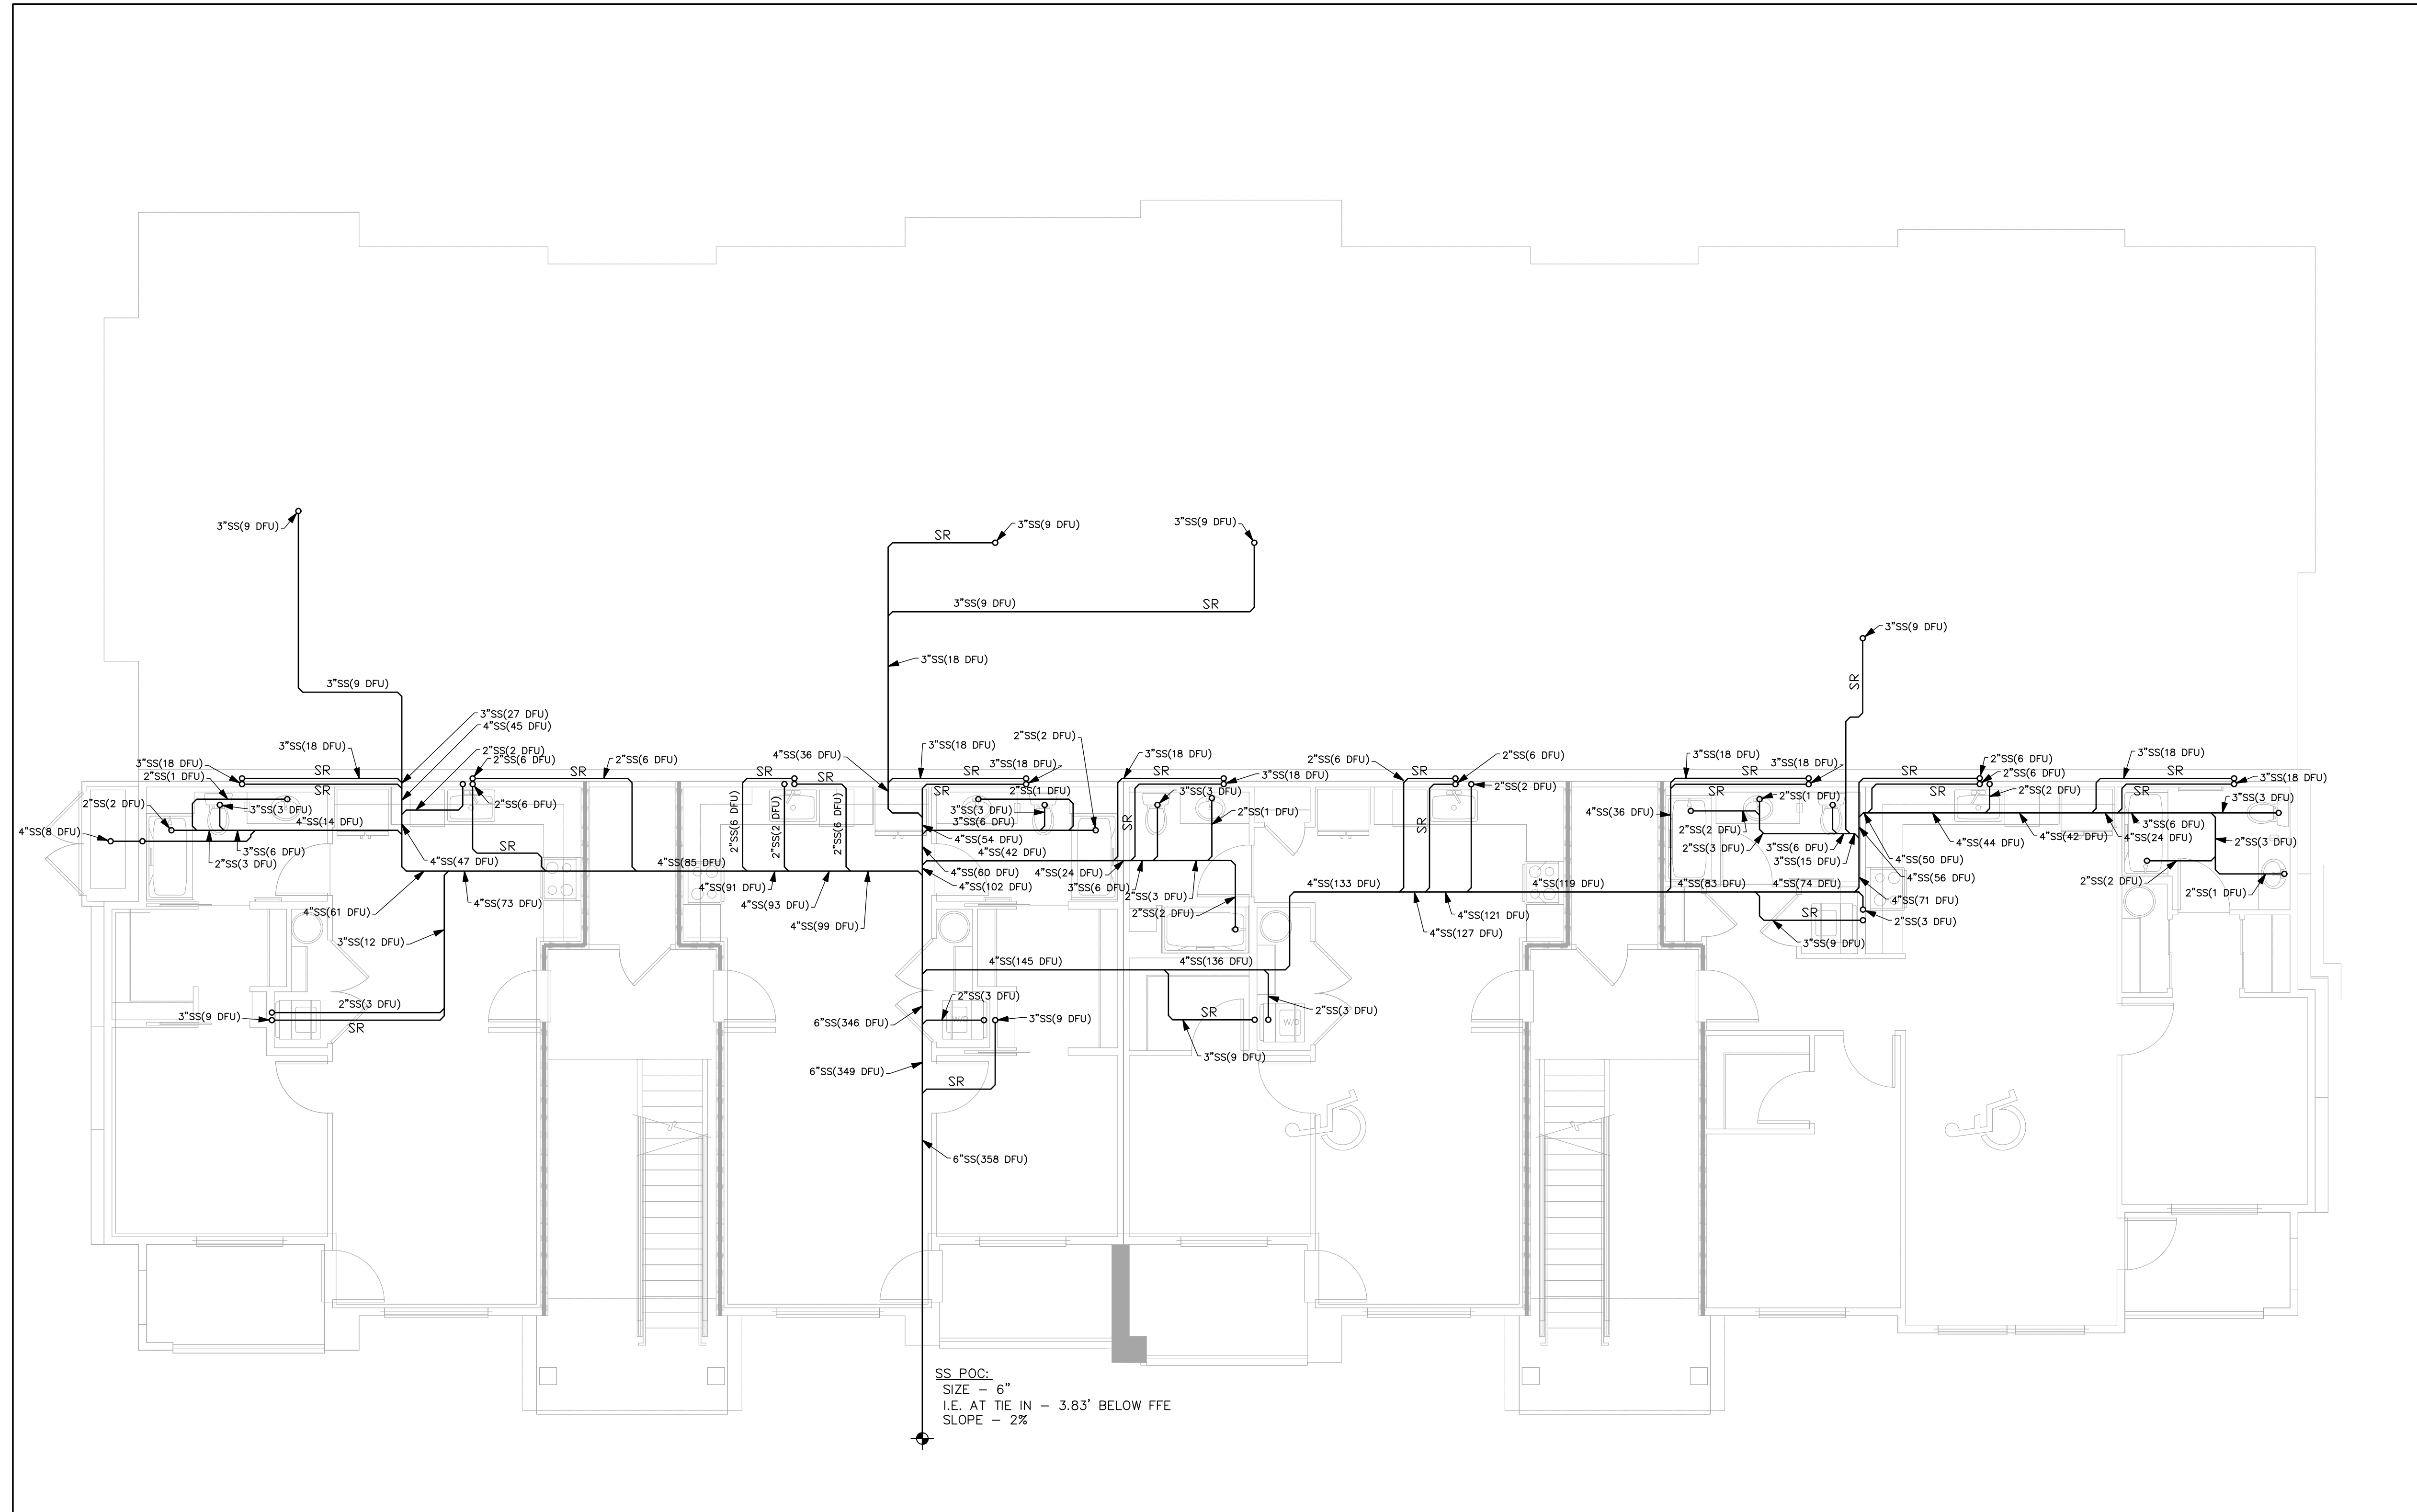

GENERAL NOTES

1. PROVIDE TRAP PRIMERS FOR ALL FLOOR DRAINS PER 2018 UPC 1007.1. SEE DETAIL 5/P7.01.
2. WASTE & VENT SIZING: WASTE & VENT PIPING IS SIZED PER 2018 UPC TABLE 703.2. DRAINAGE PIPING SHALL BE SLOPED AT 1/4" PER FOOT OR 2%. WHERE IT IS IMPRACTICAL TO OBTAIN A SLOPE OF 2% DUE TO THE DEPTH OF THE STREET SEWER OR TO STRUCTURAL FEATURES OF THE BUILDING, DRAINAGE PIPING 4" AND LARGER MAY BE SLOPED AT 1/8" PER FOOT OR 1% WITH APPROVAL FROM THE AHJ.

PIPE SIZE	VERTICAL	HORIZONTAL	VENT
1 1/2"	2 DFU	1 DFU	8 DFU
2"	16 DFU	8 DFU	24 DFU
3"	48 DFU	35 DFU	84 DFU
4"	256 DFU	172 DFU	256 DFU
6"	1,380 DFU	576 DFU	1,380 DFU
8"	3,600 DFU	2,112 DFU	3,600 DFU

FLAG NOTES #


NOT USED

BACKWATER VALVE ANALYSIS - SS P.O.C.


IF UPSTREAM MANHOLE RIM ELEVATION IS HIGHER THAN FINISH FLOOR ELEVATION CONTACT ENGINEER FOR FURTHER EVALUATION.

UNDERSLAB WASTE & VENT PLAN

SCALE: 1/4" = 1'-0"



NO.	DATE	DESCRIPTION	REVISIONS



DRAWN:	JMI	DESIGNED:	JIM	CHECKED:	RJ	APPROVED:	JR
--------	-----	-----------	-----	----------	----	-----------	----

PROJECT: **BRADLEY HEIGHT APARTMENTS - BUILDING A**
 202 27TH AVE SE
 PUYALLUP, WA 98374


19401 40TH AVE W. SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 864-3343

ROBISON ENGINEERING, INC.

DATE: 2/14/2024

SHEET TITLE:
UNDERSLAB WASTE & VENT PLAN

SHEET NO.
P2A.00

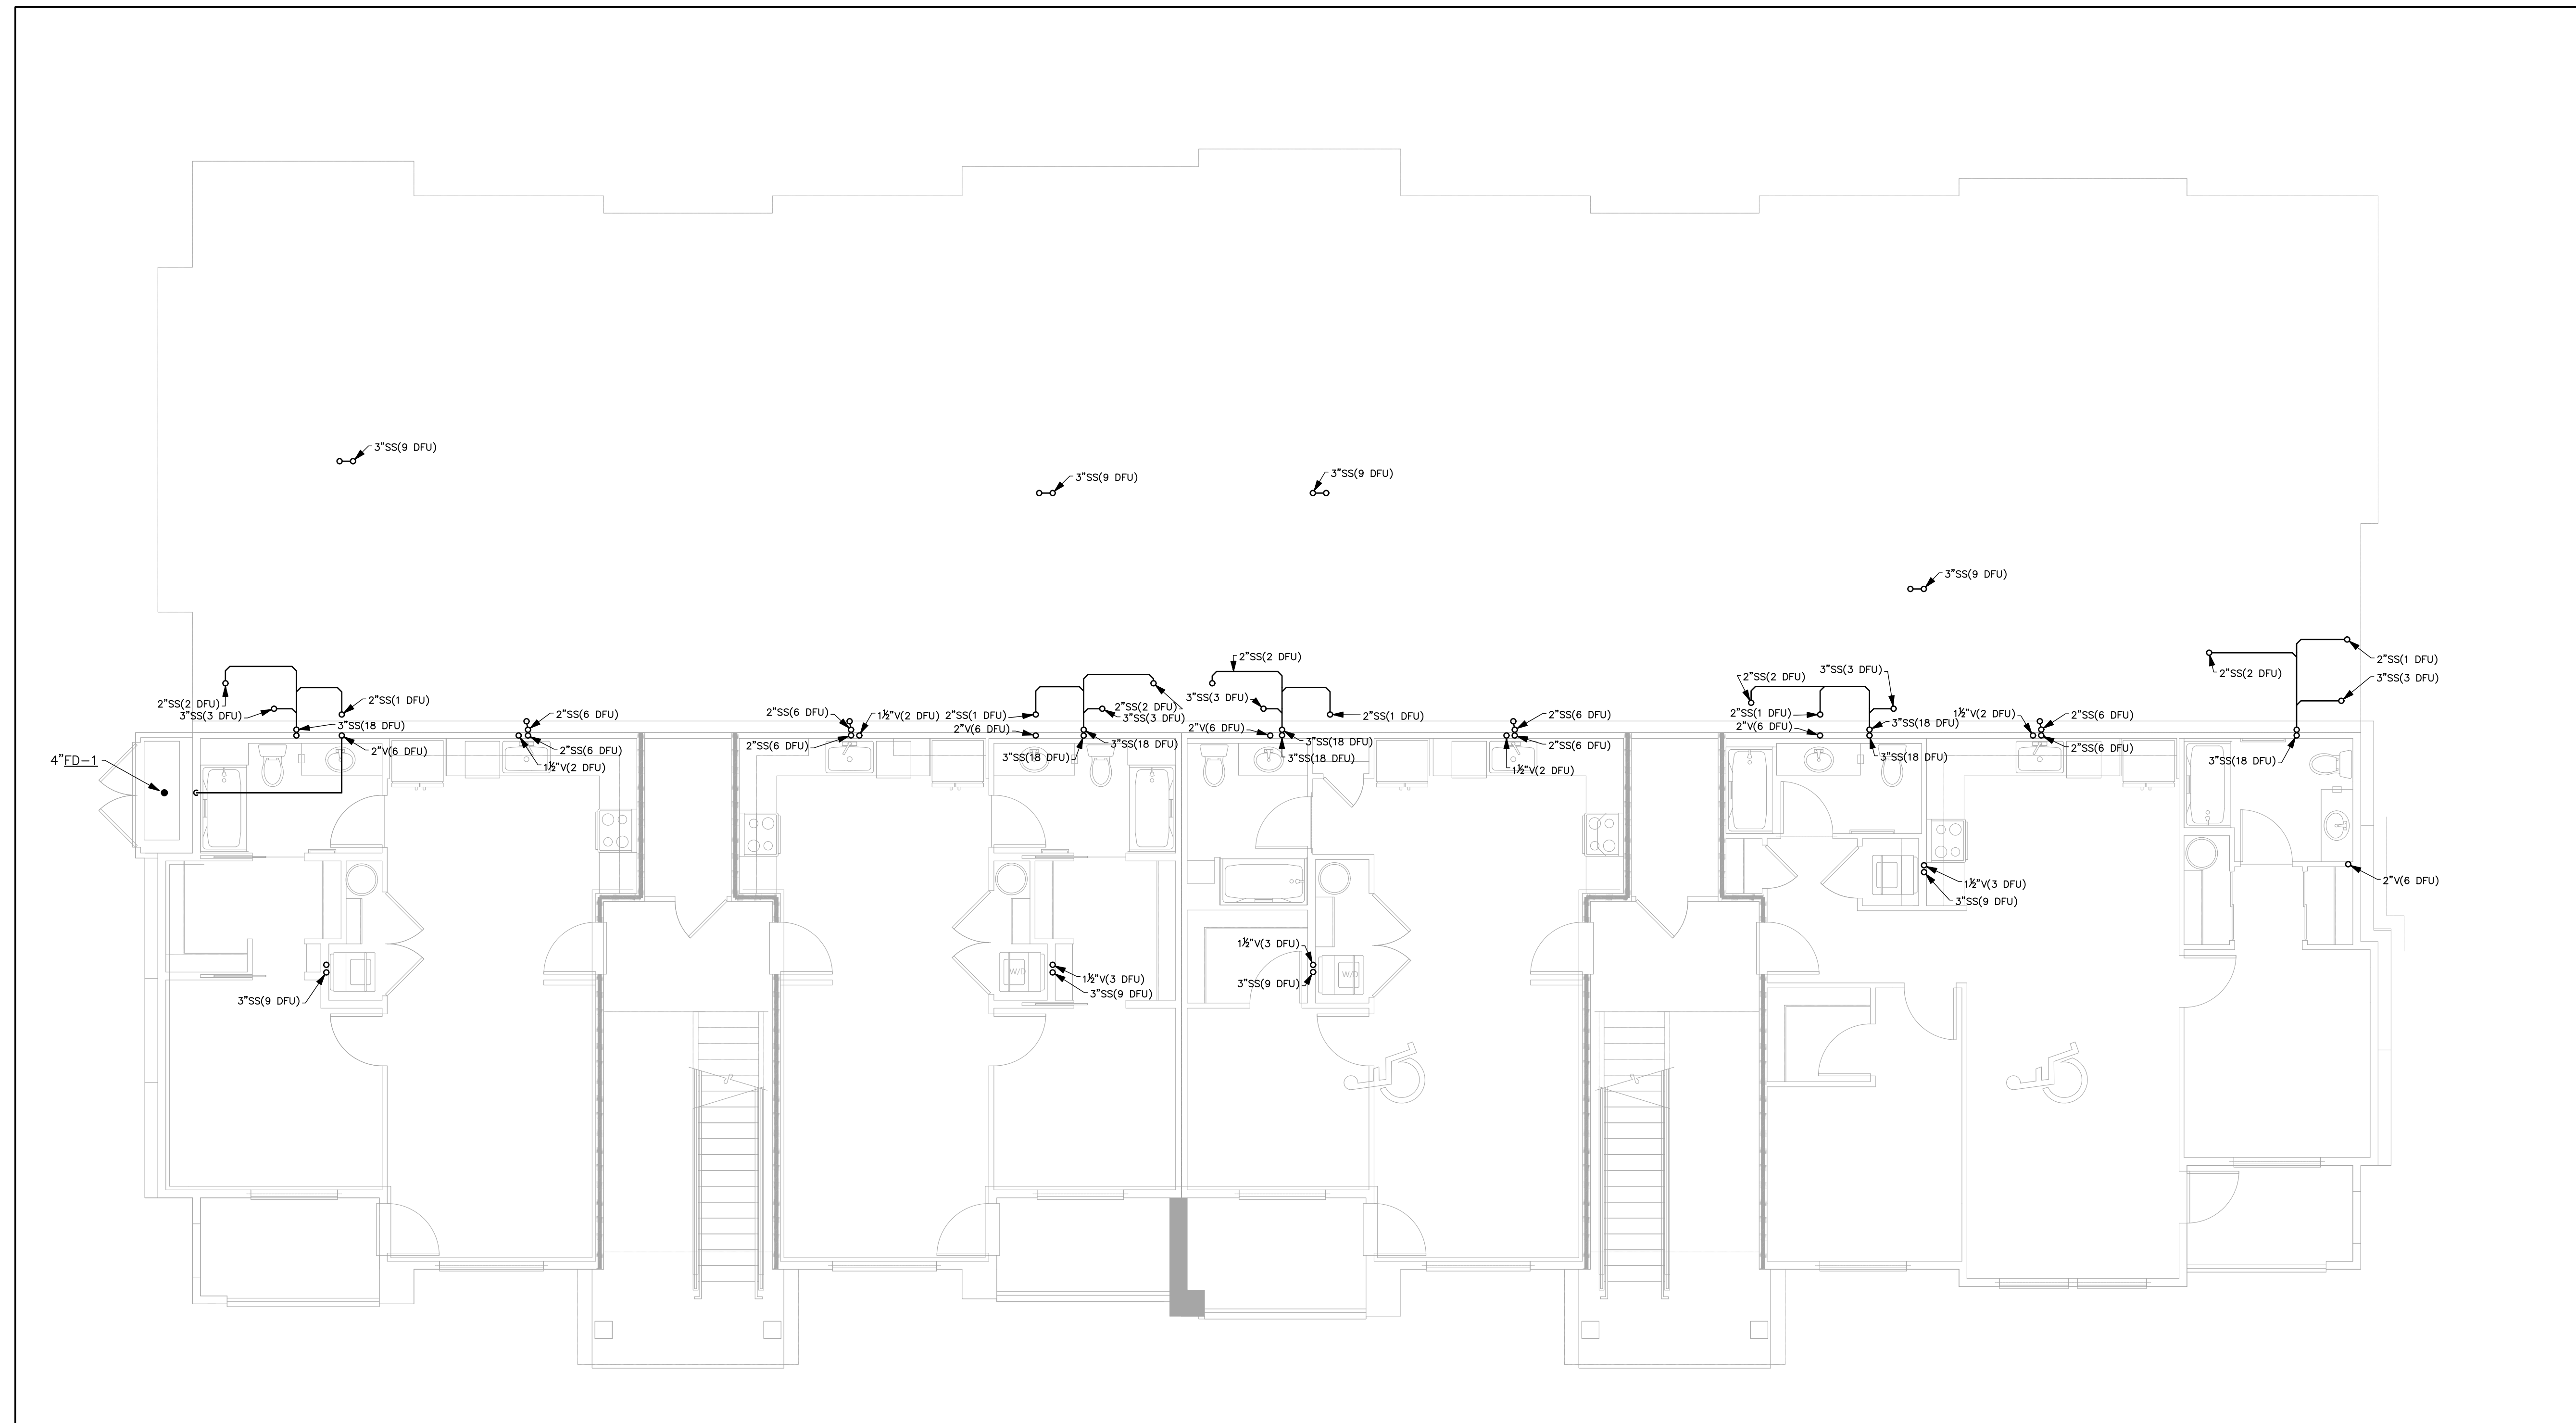

GENERAL NOTES

1. PROVIDE TRAP PRIMERS FOR ALL FLOOR DRAINS PER 2018 UPC 1007.1. SEE DETAIL 5/P7.01.
2. WASTE & VENT SIZING: WASTE & VENT PIPING IS SIZED PER 2018 UPC TABLE 703.2. DRAINAGE PIPING SHALL BE SLOPED AT 1/4" PER FOOT OR 2%. WHERE IT IS IMPRACTICAL TO OBTAIN A SLOPE OF 2% DUE TO THE DEPTH OF THE STREET SEWER OR TO STRUCTURAL FEATURES OF THE BUILDING, DRAINAGE PIPING 4" AND LARGER MAY BE SLOPED AT 1/8" PER FOOT OR 1% WITH APPROVAL FROM THE AHJ.

PIPE SIZE	VERTICAL	HORIZONTAL	VENT
1 1/2"	2 DFU	1 DFU	8 DFU
2"	16 DFU	8 DFU	24 DFU
3"	48 DFU	35 DFU	84 DFU
4"	256 DFU	172 DFU	256 DFU
6"	1,380 DFU	576 DFU	1,380 DFU
8"	3,600 DFU	2,112 DFU	3,600 DFU

FLAG NOTES

NOT USED

BASEMENT WASTE & VENT PLAN

SCALE: 1/4" = 1'-0"



NO.	DATE	DESCRIPTION	REVISIONS



DRAWN:	JM	DESIGNED:	JM	CHECKED:	RJ	APPROVED:	JR
--------	----	-----------	----	----------	----	-----------	----


BRADLEY HEIGHT APARTMENTS - BUILDING A
 202 27TH AVE SE
 PUYALLUP, WA 98374

ROBISON ENGINEERING, INC
 19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206/364-3943

DATE:	2/14/2024
-------	-----------

SHEET TITLE:
BASEMENT WASTE & VENT PLAN

SHEET NO.
P2A.01

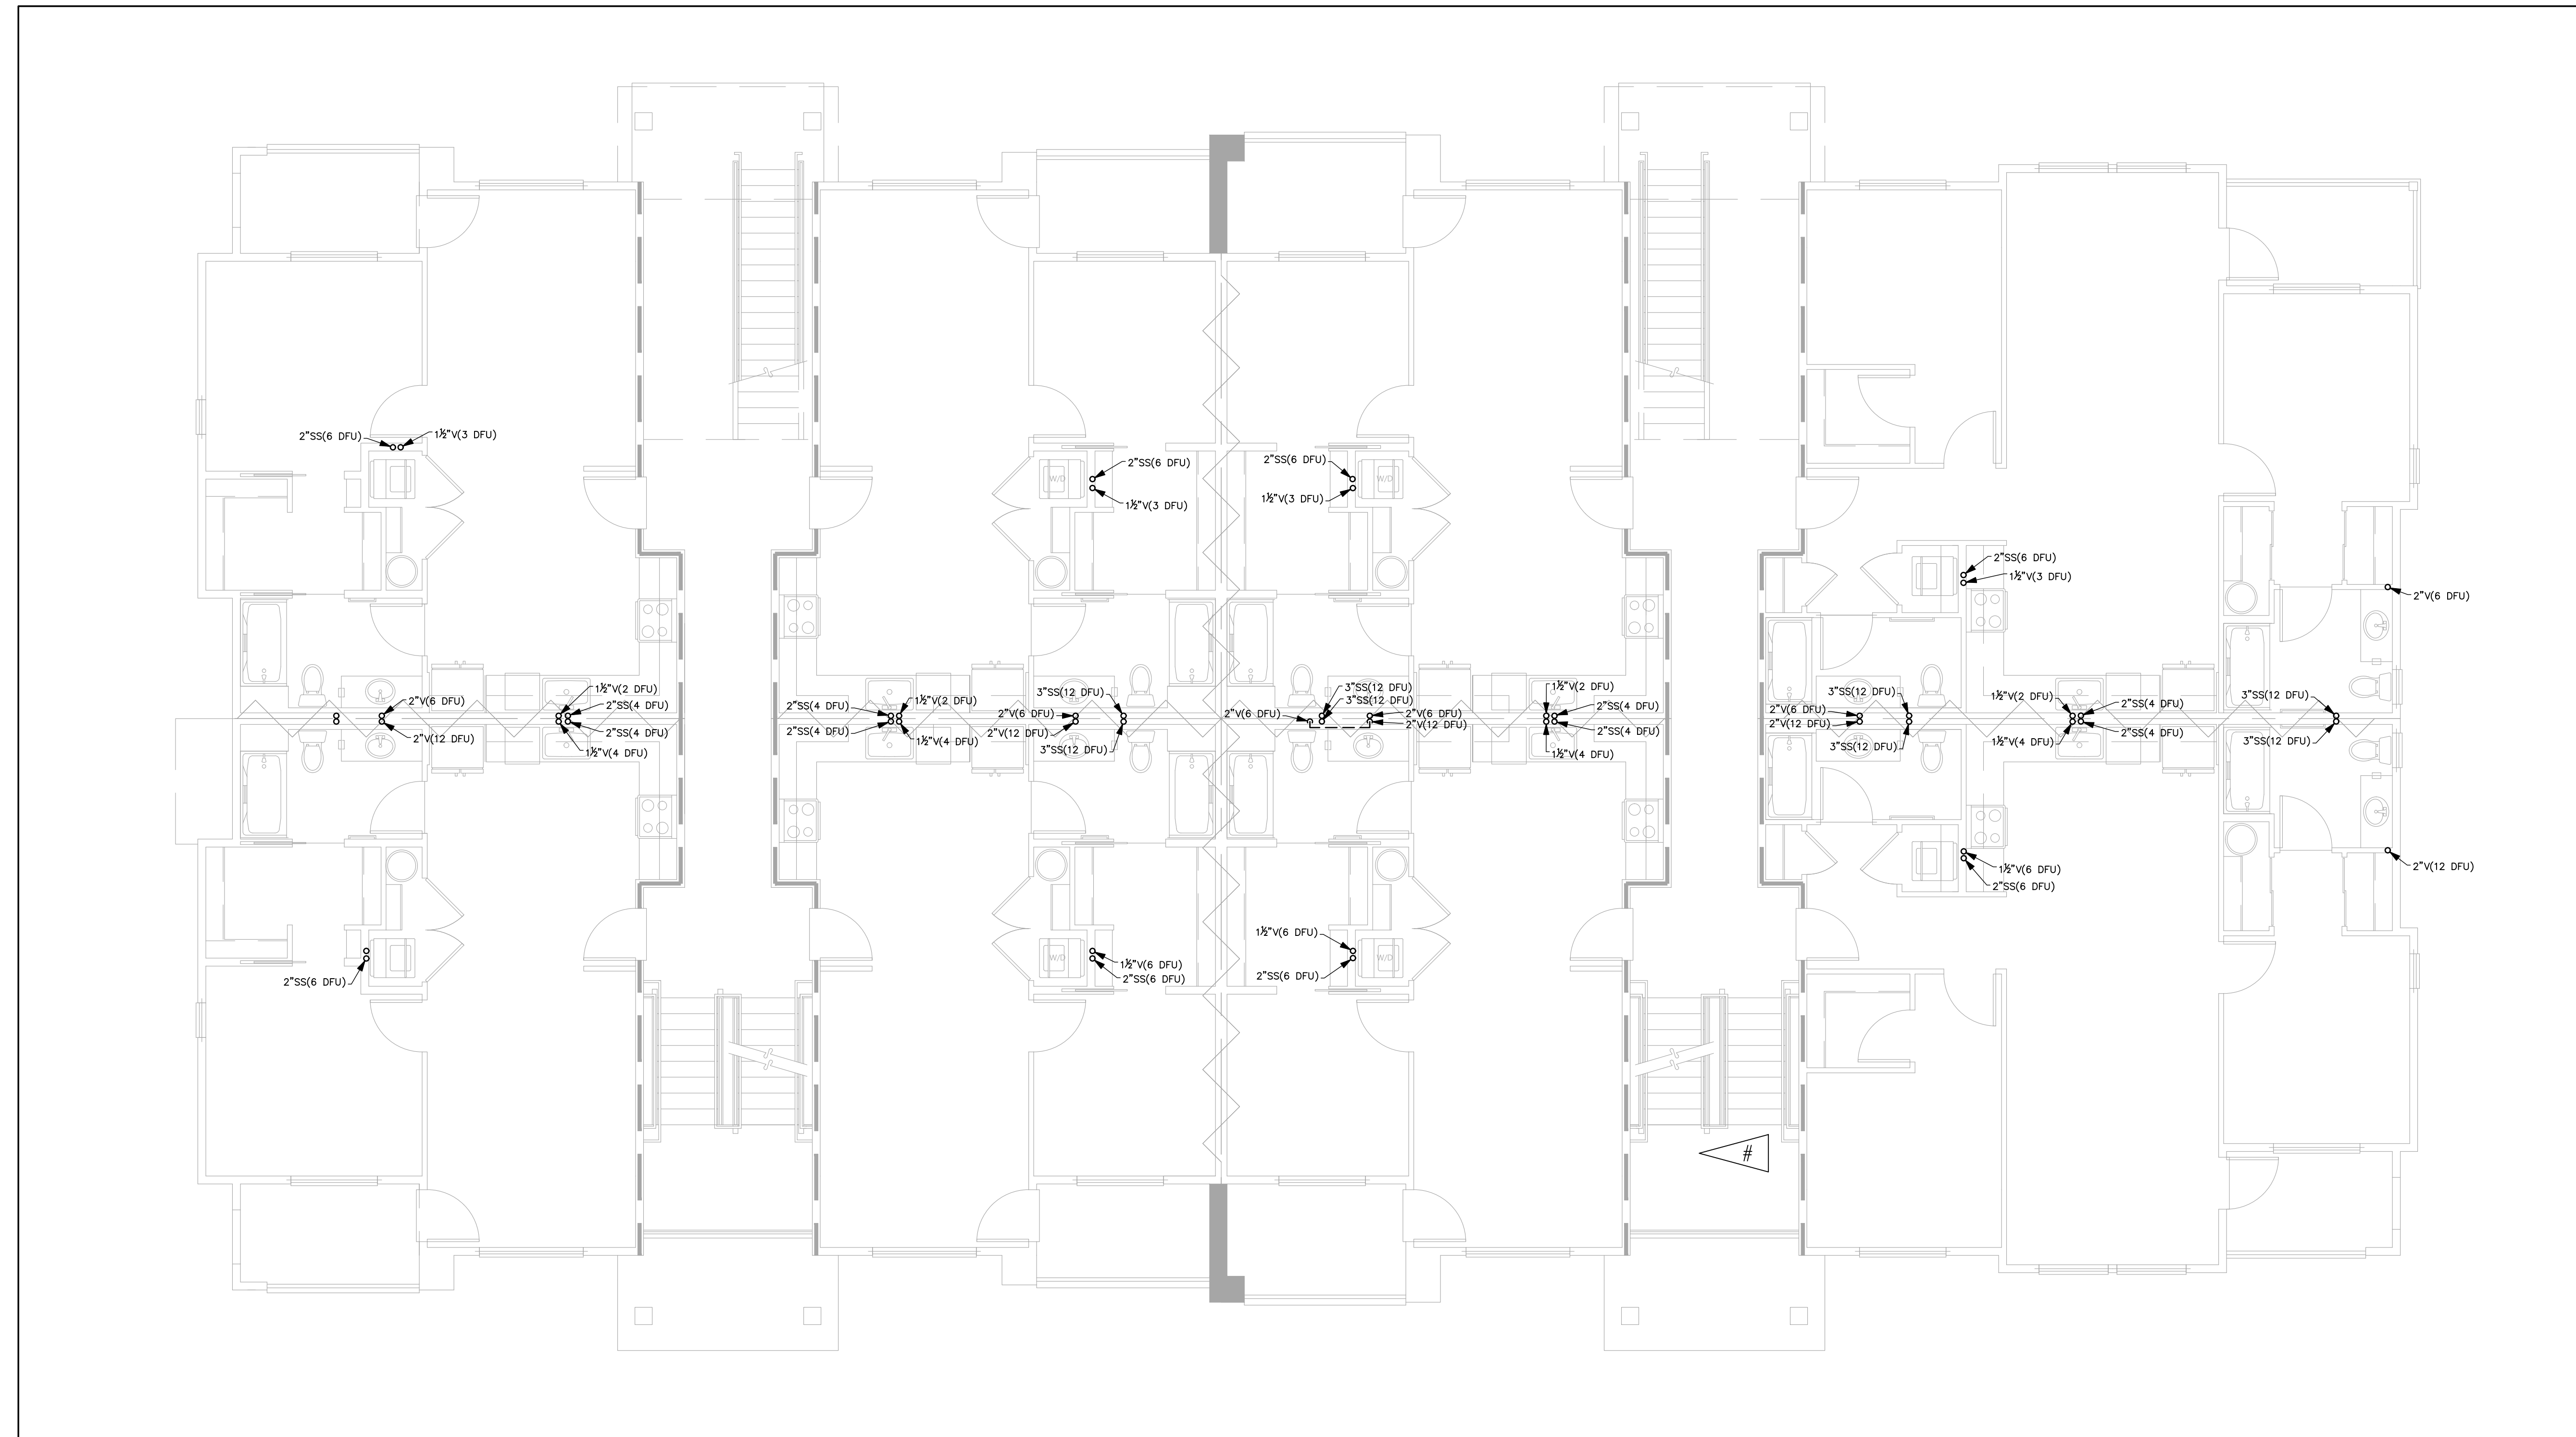

GENERAL NOTES

1. PROVIDE TRAP PRIMERS FOR ALL FLOOR DRAINS PER 2018 UPC 1007.1. SEE DETAIL 5/P7.01.
2. WASTE & VENT SIZING: WASTE & VENT PIPING IS SIZED PER 2018 UPC TABLE 703.2. DRAINAGE PIPING SHALL BE SLOPED AT 1/4" PER FOOT OR 2%. WHERE IT IS IMPRACTICAL TO OBTAIN A SLOPE OF 2% DUE TO THE DEPTH OF THE STREET SEWER OR TO STRUCTURAL FEATURES OF THE BUILDING, DRAINAGE PIPING 4" AND LARGER MAY BE SLOPED AT 1/8" PER FOOT OR 1% WITH APPROVAL FROM THE AHJ.


PIPE SIZE	VERTICAL	HORIZONTAL	VENT
1 1/2"	2 DFU	1 DFU	8 DFU
2"	16 DFU	8 DFU	24 DFU
3"	48 DFU	35 DFU	84 DFU
4"	256 DFU	172 DFU	256 DFU
6"	1,380 DFU	576 DFU	1,380 DFU
8"	3,600 DFU	2,112 DFU	3,600 DFU

FLAG NOTES


NOT USED

LEVEL 1 WASTE & VENT PLAN

SCALE: 1/4" = 1'-0"



NO.	DATE	DESCRIPTION	REVISIONS

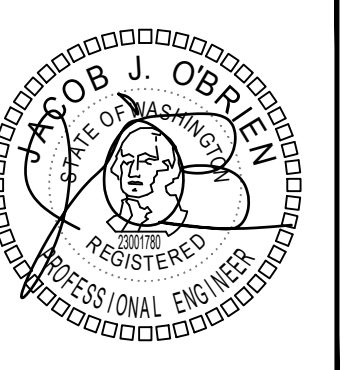

DRAWN:	JM
DESIGNED:	JM
CHECKED:	RJ
APPROVED:	JR

PROJECT: **BRADLEY HEIGHT APARTMENTS - BUILDING A**
 202 27TH AVE SE
 PUYALLUP, WA 98374


19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343

ROBISON ENGINEERING, INC

DATE: 2/14/2024

SHEET TITLE:
LEVEL 1 WASTE & VENT PLAN

SHEET NO.
P2A.02

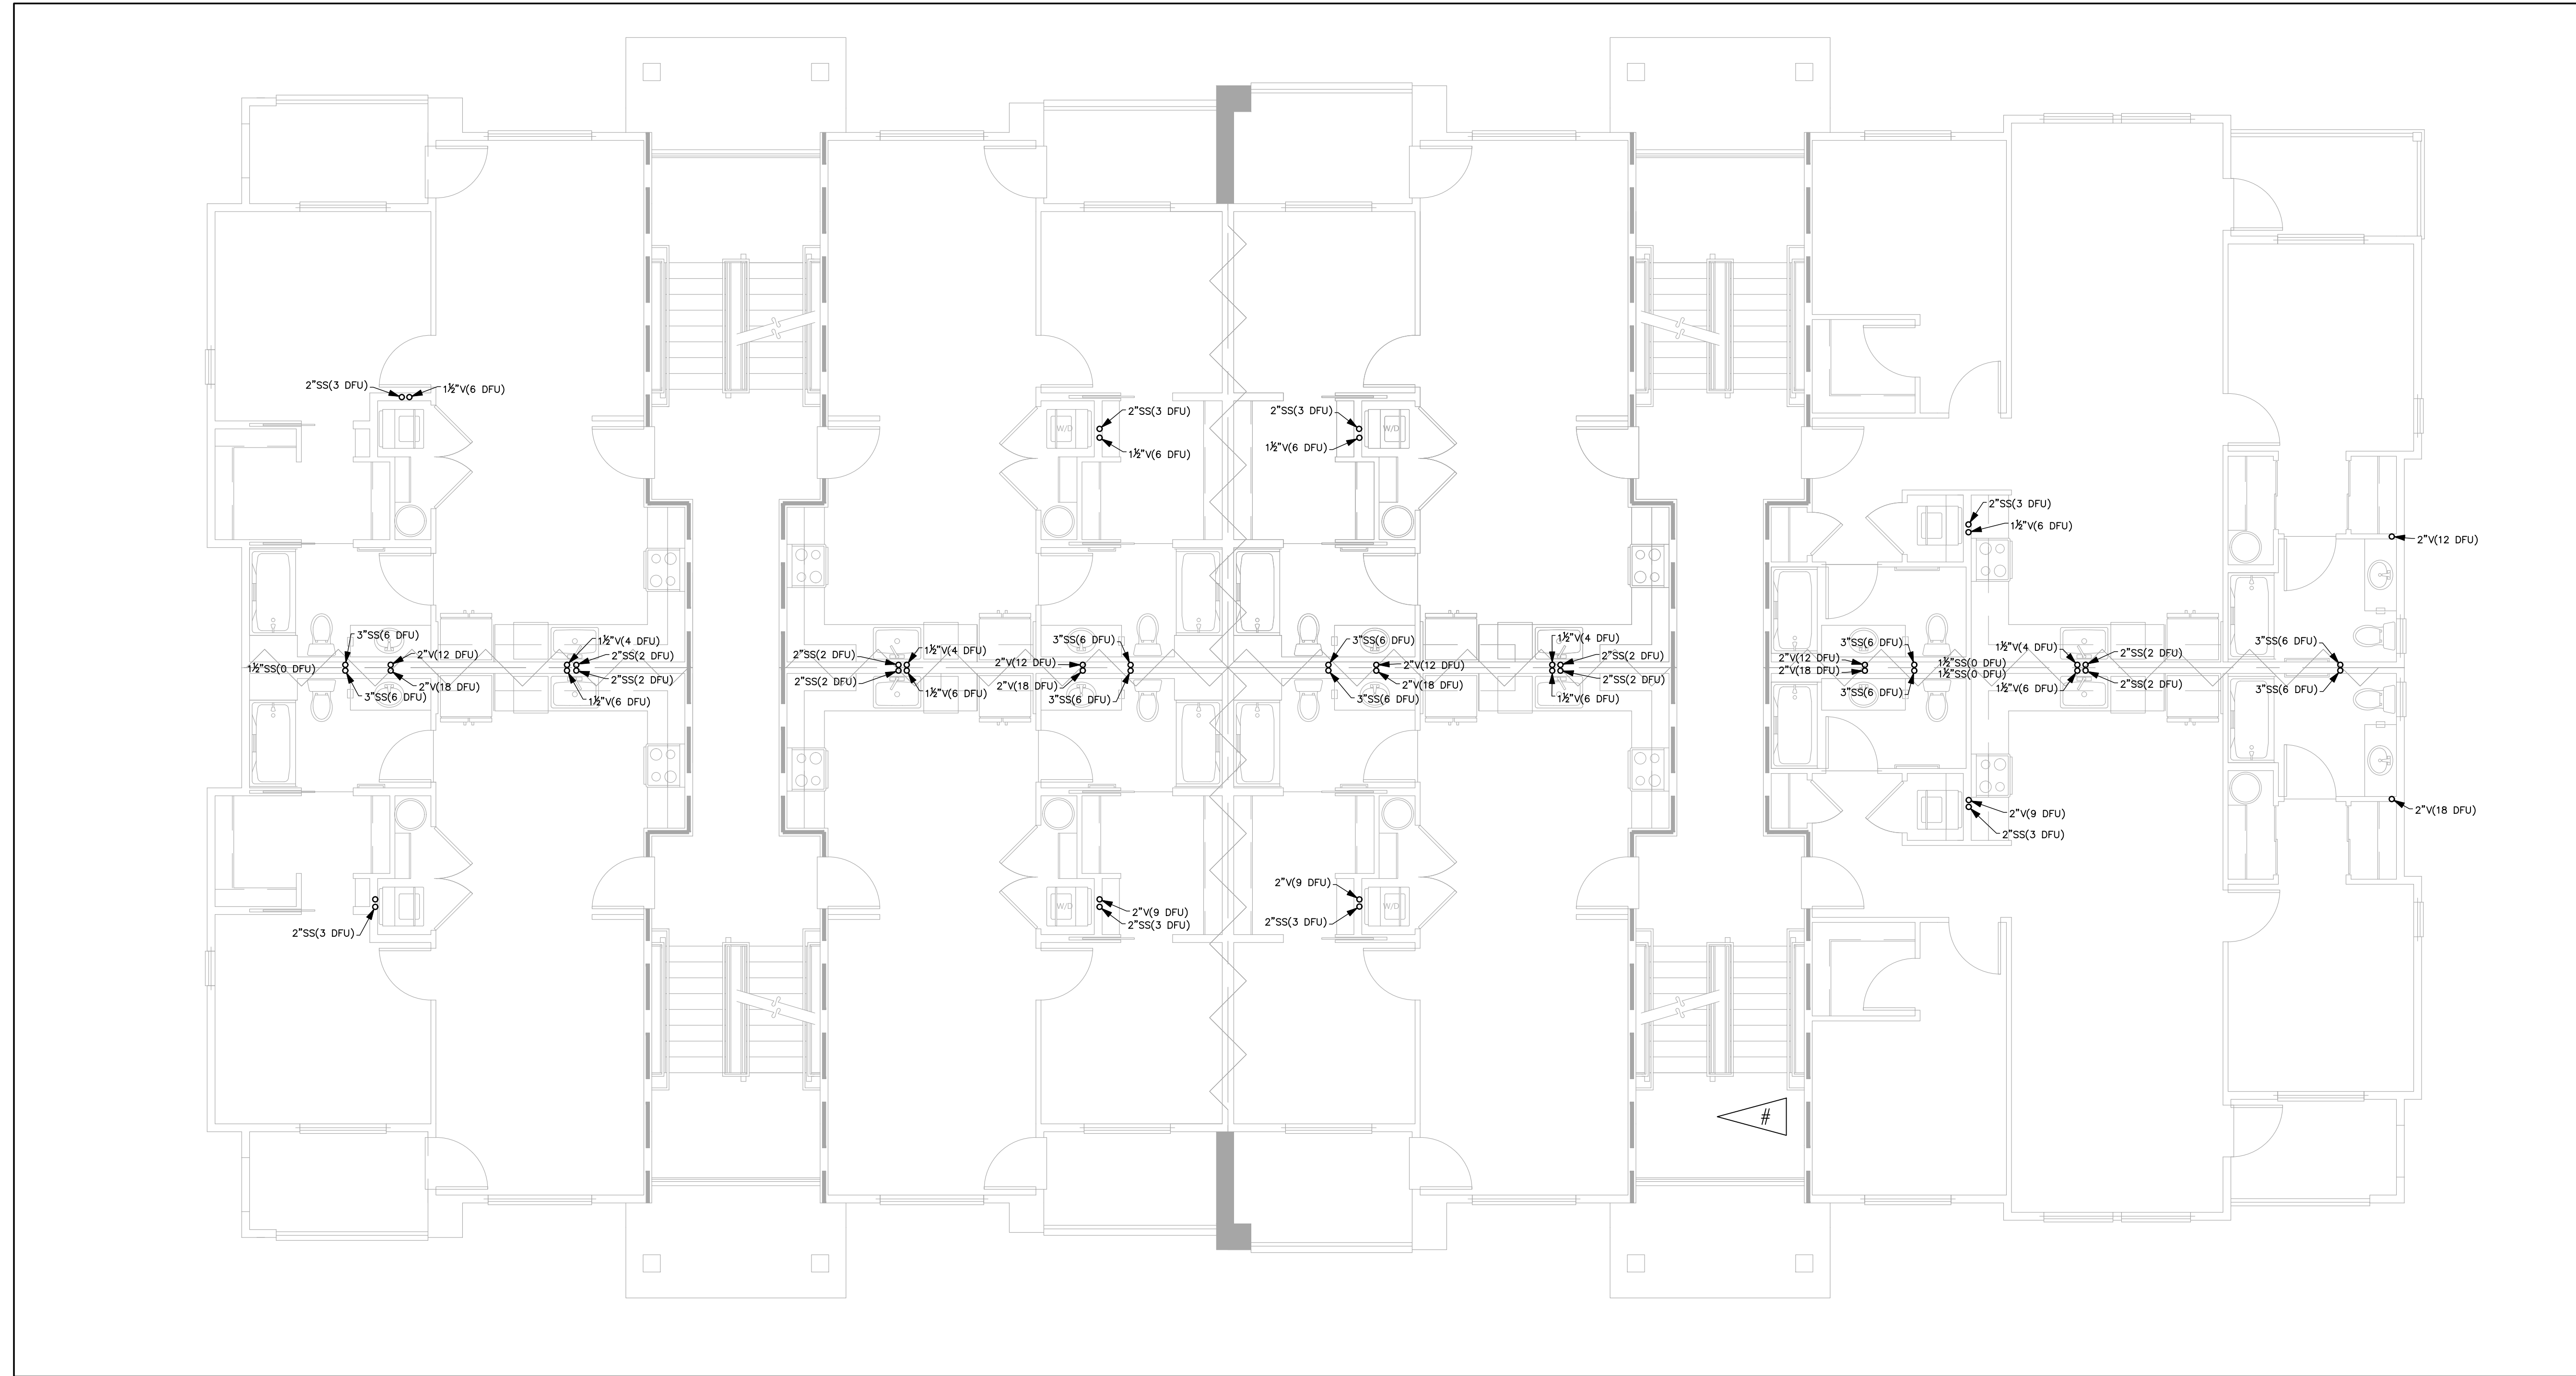

GENERAL NOTES


1. PROVIDE TRAP PRIMERS FOR ALL FLOOR DRAINS PER 2018 UPC 1007.1. SEE DETAIL 5/P7.01.
2. WASTE & VENT SIZING: WASTE & VENT PIPING IS SIZED PER 2018 UPC TABLE 703.2. DRAINAGE PIPING SHALL BE SLOPED AT 1/4" PER FOOT OR 2% WHERE IT IS IMPRACTICAL TO OBTAIN A SLOPE OF 2% DUE TO THE DEPTH OF THE STREET SEWER OR TO STRUCTURAL FEATURES OF THE BUILDING, DRAINAGE PIPING 4" AND LARGER MAY BE SLOPED AT 1/8" PER FOOT OR 1% WITH APPROVAL FROM THE AHJ.

PIPE SIZE	VERTICAL	HORIZONTAL	VENT
1 1/2"	2 DFU	1 DFU	8 DFU
2"	16 DFU	8 DFU	24 DFU
3"	48 DFU	35 DFU	84 DFU
4"	256 DFU	172 DFU	256 DFU
6"	1,380 DFU	576 DFU	1,380 DFU
8"	3,600 DFU	2,112 DFU	3,600 DFU

FLAG NOTES

NOT USED

NO.	DATE	DESCRIPTION	REVISIONS

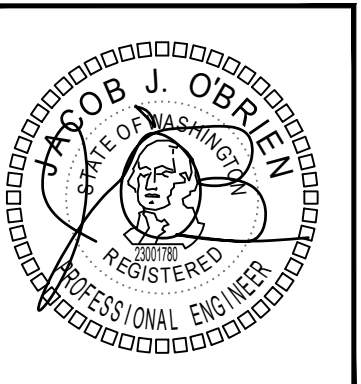

DRAWN:	JM	DESIGNED:	JM	CHECKED:	RJ	APPROVED:	JR
--------	----	-----------	----	----------	----	-----------	----

PROJECT: **BRADLEY HEIGHT APARTMENTS - BUILDING A**
 202 27TH AVE SE
 PUYALLUP, WA 98374

19401 40TH AVE. W. SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343


ROBISON ENGINEERING, INC.


DATE: 2/14/2024

SHEET TITLE:
LEVEL 2 WASTE & VENT PLAN

SHEET NO.
P2A.03

LEVEL 2 WASTE & VENT PLAN
 SCALE: 1/4" = 1'-0"



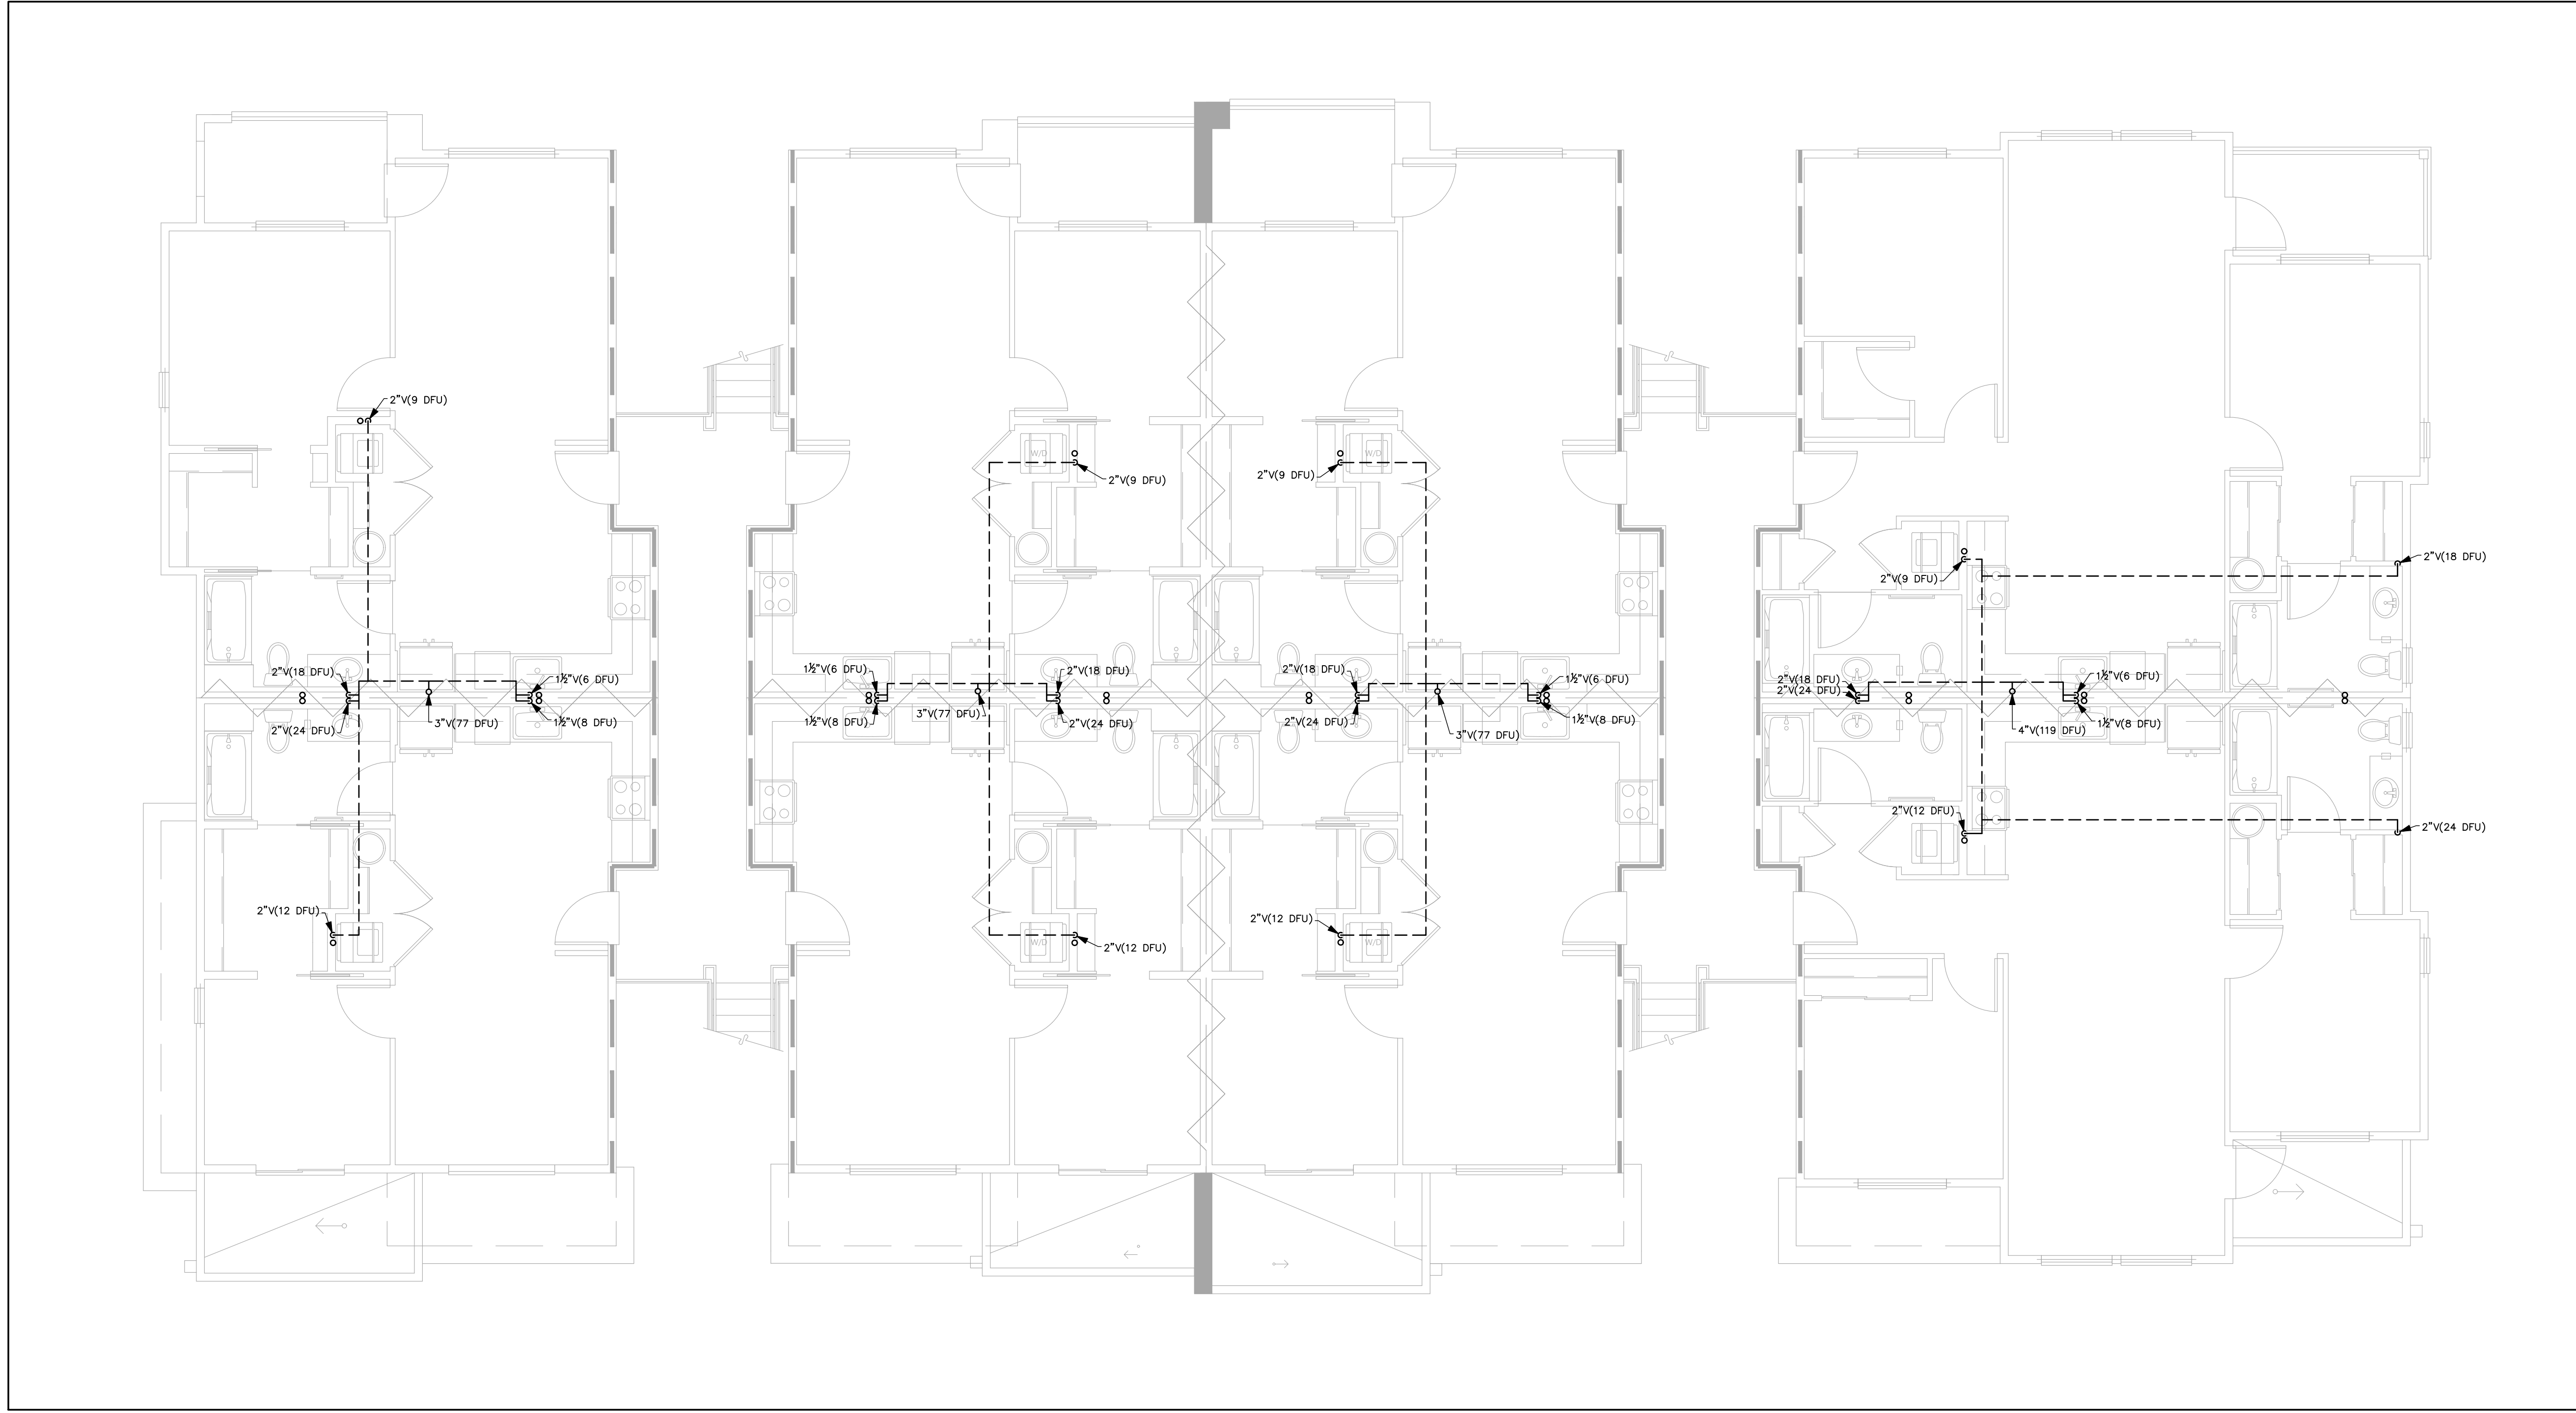


GENERAL NOTES

1. PROVIDE TRAP PRIMERS FOR ALL FLOOR DRAINS PER 2018 UPC 1007.1. SEE DETAIL 5/P7.01.
2. WASTE & VENT SIZING: WASTE & VENT PIPING IS SIZED PER 2018 UPC TABLE 703.2. DRAINAGE PIPING SHALL BE SLOPED AT 1/4" PER FOOT OR 2%. WHERE IT IS IMPRACTICAL TO OBTAIN A SLOPE OF 2% DUE TO THE DEPTH OF THE STREET SEWER OR TO STRUCTURAL FEATURES OF THE BUILDING, DRAINAGE PIPING 4" AND LARGER MAY BE SLOPED AT 1/8" PER FOOT OR 1% WITH APPROVAL FROM THE AHJ.

PIPE SIZE	VERTICAL	HORIZONTAL	VENT
1 1/2"	2 DFU	1 DFU	8 DFU
2"	16 DFU	8 DFU	24 DFU
3"	48 DFU	35 DFU	84 DFU
4"	256 DFU	172 DFU	256 DFU
6"	1,380 DFU	576 DFU	1,380 DFU
8"	3,600 DFU	2,112 DFU	3,600 DFU


FLAG NOTES




NOT USED

LEVEL 3 WASTE & VENT PLAN

SCALE: 1/4" = 1'-0"



NO.	DATE	DESCRIPTION	REVISIONS

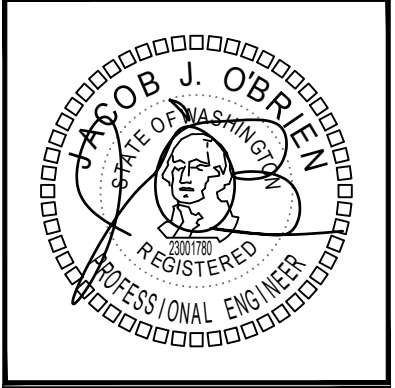

DRAWN:	JM	DESIGNED:	JM	CHECKED:	RJ	APPROVED:	JR
--------	----	-----------	----	----------	----	-----------	----

PROJECT: **BRADLEY HEIGHT APARTMENTS - BUILDING A**
 202 27TH AVE SE
 PUYALLUP, WA 98374


19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-5343

ROBISON ENGINEERING, INC

DATE: 2/14/2024

SHEET TITLE:
LEVEL 3 WASTE & VENT PLAN

SHEET NO.
P2A.04

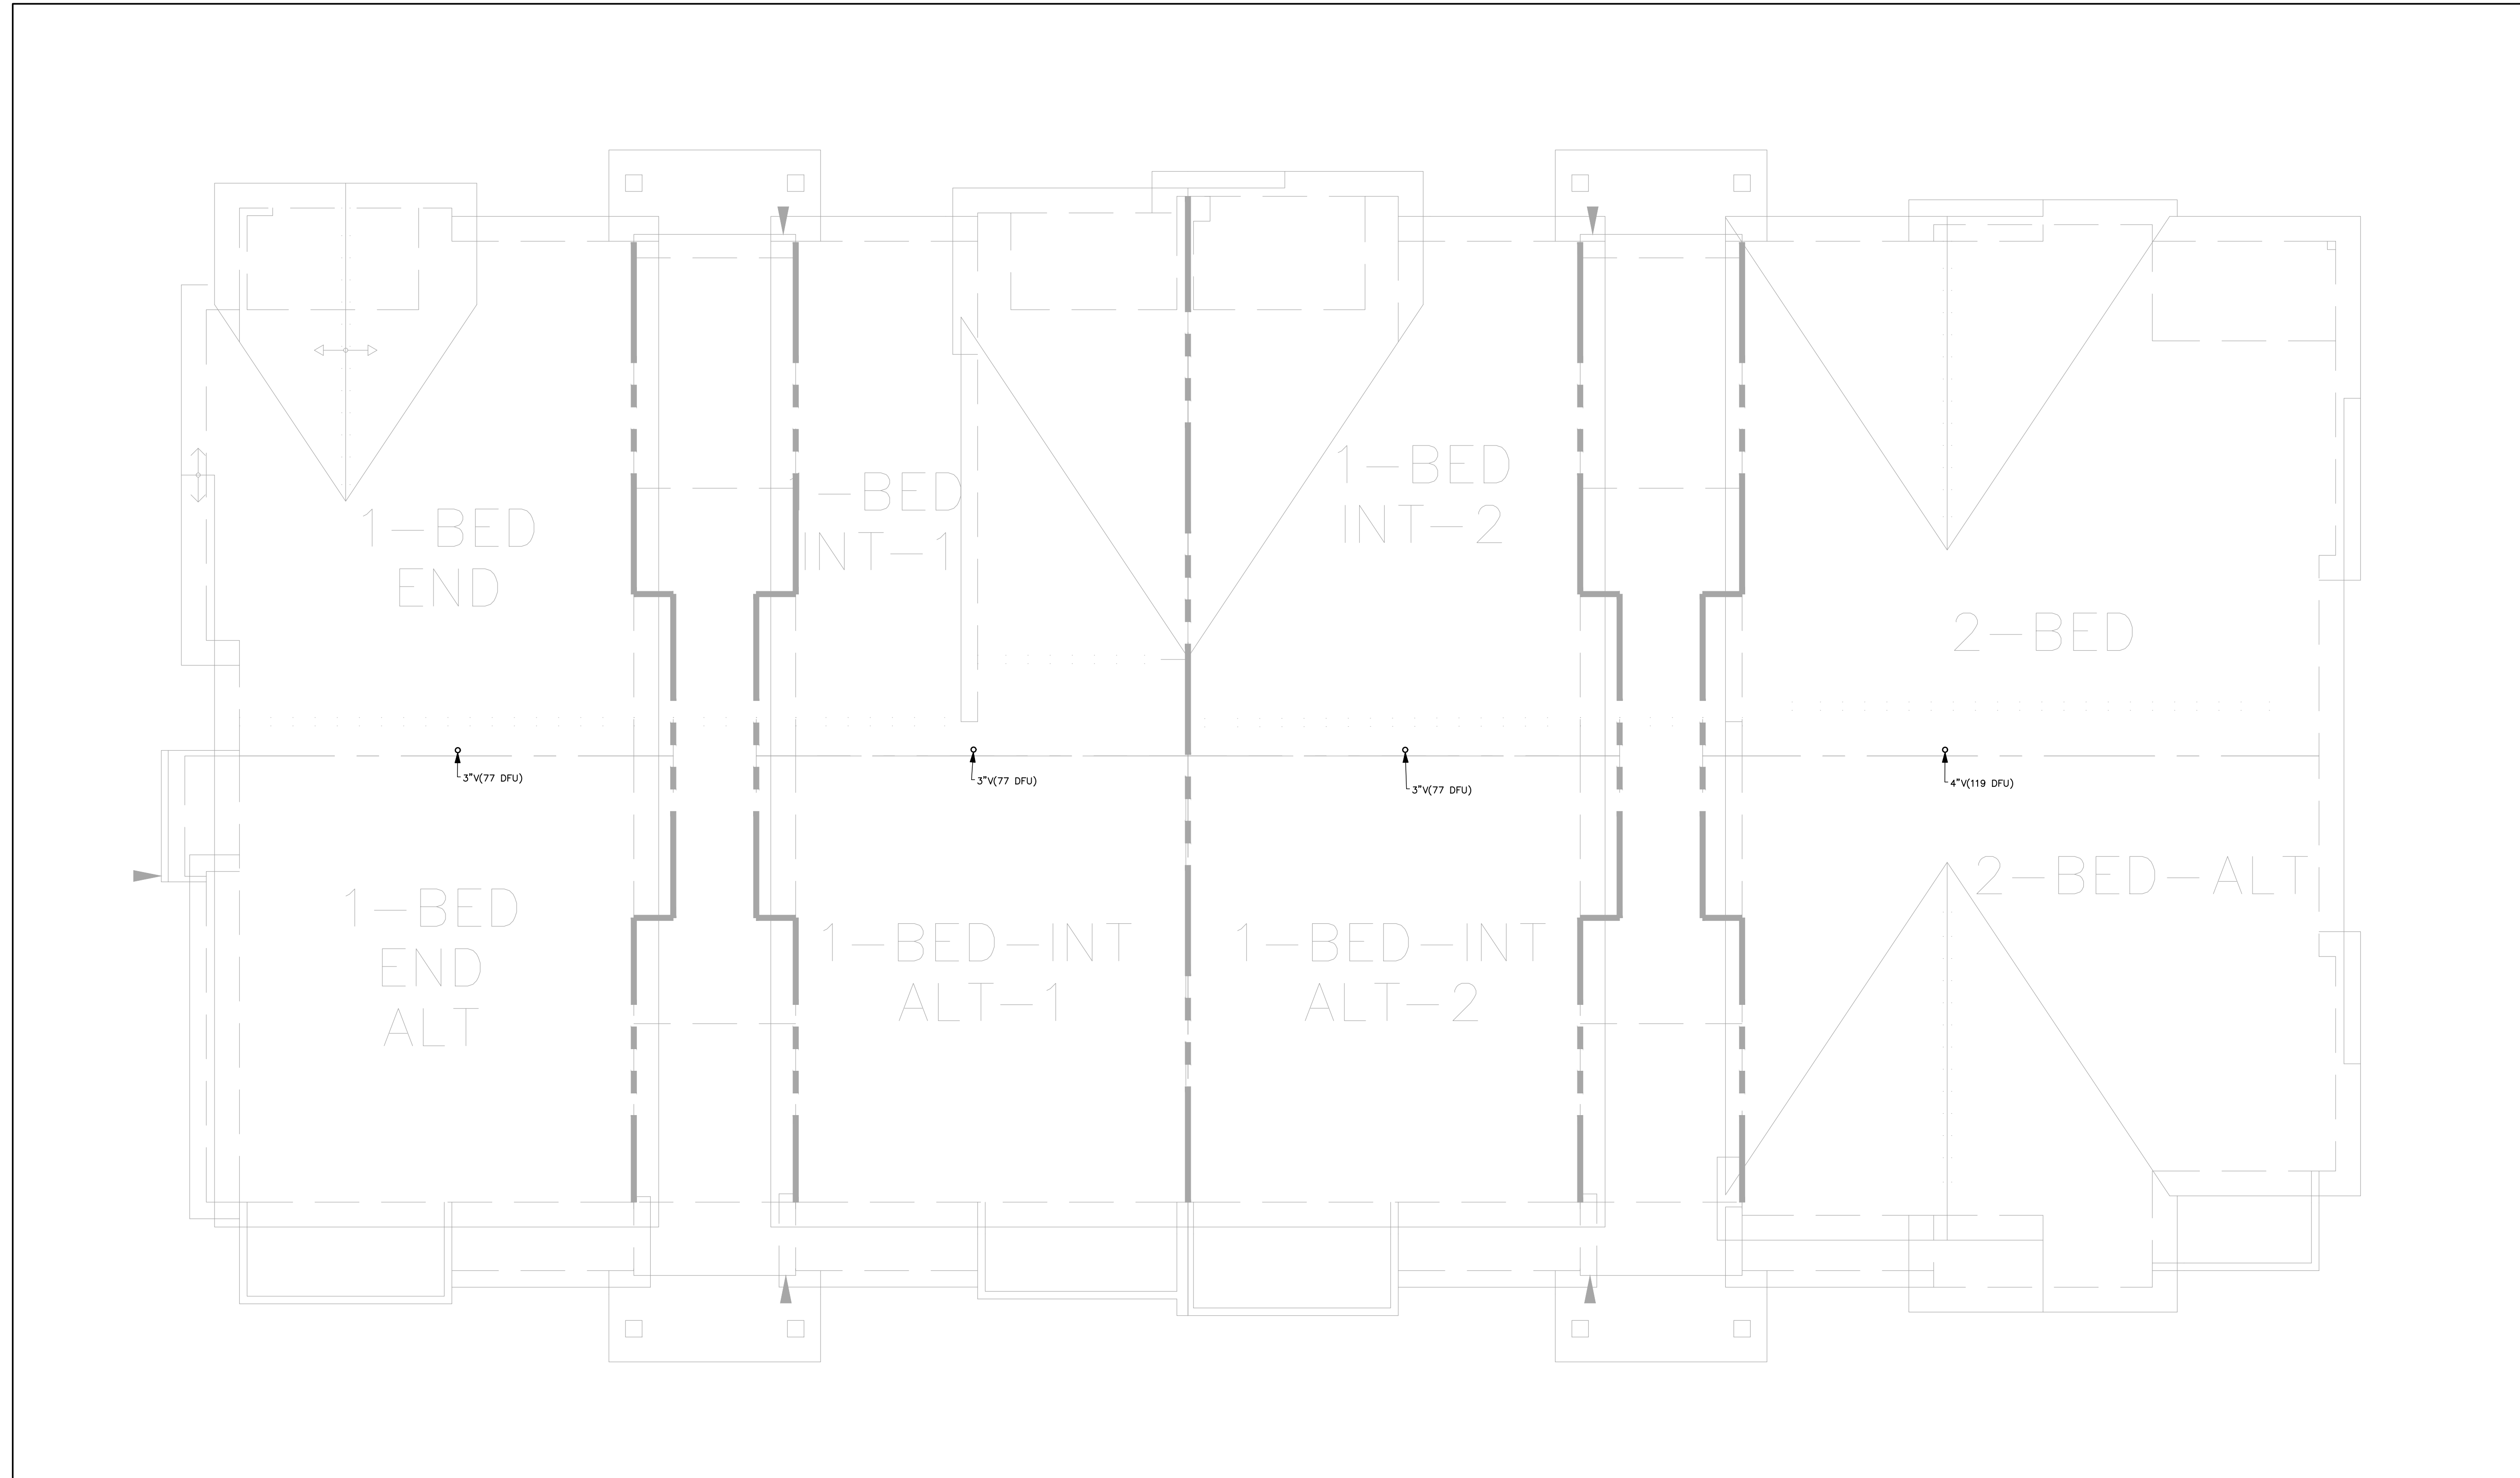

GENERAL NOTES


1. PROVIDE TRAP PRIMERS FOR ALL FLOOR DRAINS PER 2018 UPC 1007.1. SEE DETAIL 5/P7.01.
2. WASTE & VENT SIZING: WASTE & VENT PIPING IS SIZED PER 2018 UPC TABLE 703.2. DRAINAGE PIPING SHALL BE SLOPED AT 1/4" PER FOOT OR 2%. WHERE IT IS IMPRACTICAL TO OBTAIN A SLOPE OF 2% DUE TO THE DEPTH OF THE STREET SEWER OR TO STRUCTURAL FEATURES OF THE BUILDING, DRAINAGE PIPING 4" AND LARGER MAY BE SLOPED AT 1/8" PER FOOT OR 1% WITH APPROVAL FROM THE AHJ.

PIPE SIZE	VERTICAL	HORIZONTAL	VENT
1 1/2"	2 DFU	1 DFU	8 DFU
2"	16 DFU	8 DFU	24 DFU
3"	48 DFU	35 DFU	84 DFU
4"	256 DFU	172 DFU	256 DFU
6"	1,380 DFU	576 DFU	1,380 DFU
8"	3,600 DFU	2,112 DFU	3,600 DFU



FLAG NOTES

NOT USED

ROOF WASTE & VENT PLAN
SCALE: 1/4" = 1'-0"



NO.	DATE	DESCRIPTION	REVISIONS

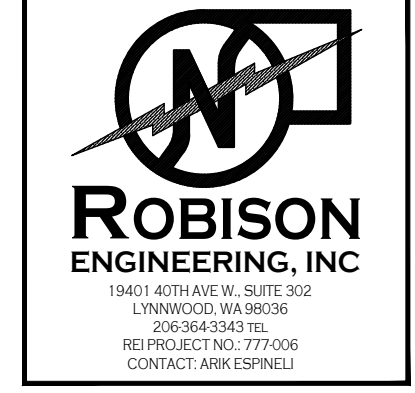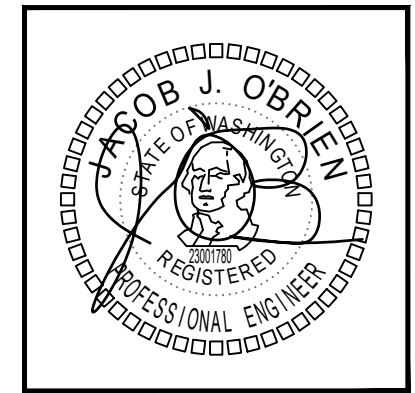

DRAWN:	JM
DESIGNED:	JM
CHECKED:	RJ
APPROVED:	JR

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A
202 27TH AVE SE
PUYALLUP, WA 98374

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206)364-3343


ROBISON ENGINEERING, INC.

DATE: 2/14/2024

SHEET TITLE:
ROOF WASTE & VENT PLAN

SHEET NO:
P2A.05

IDENTIFY ALL RATED WALLS AND STAIR CONSTRUCTION (R6) FOR ANY PLUMBING IN FIRE RATED PENETRATIONS REQUIRED. PAGE P3A.01

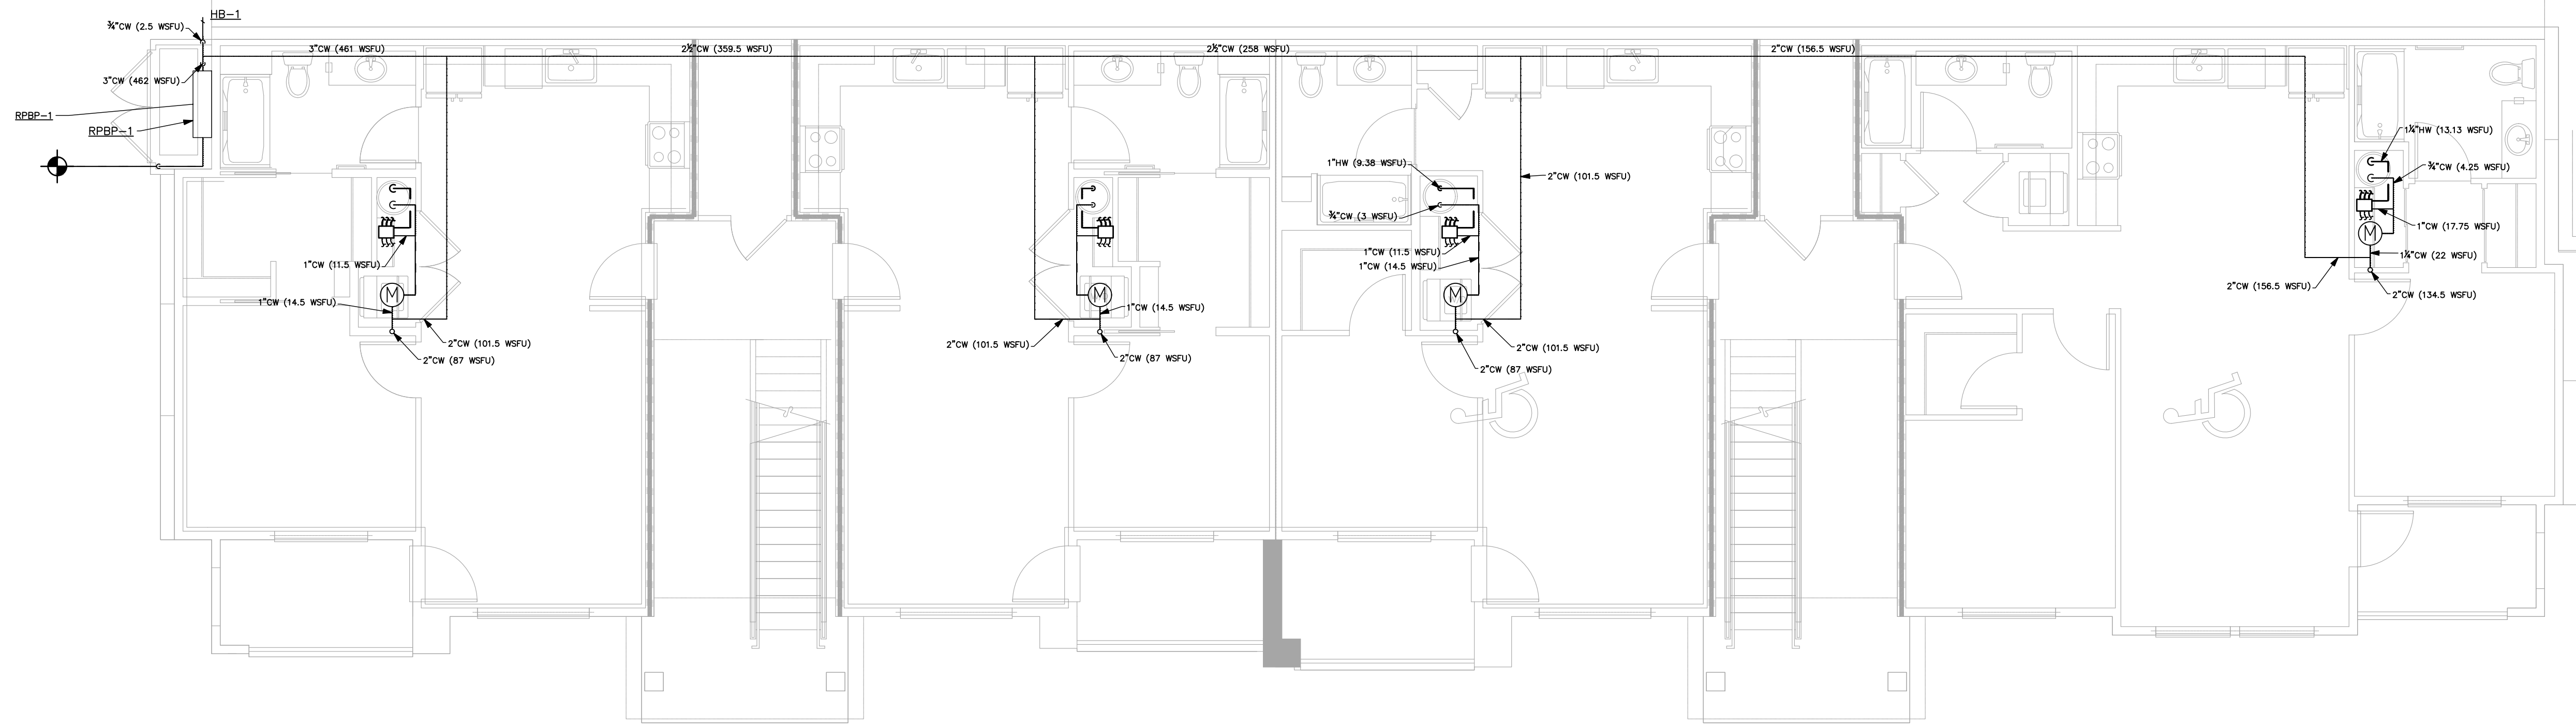

GENERAL NOTES

1. PROVIDE EXPANSION LOOPS FOR ALL WATER PIPING PER THE MANUFACTURER'S INSTRUCTIONS. SEE DETAIL 3/P7.01.
2. INSTALL HEAT TRACE ON SUPPLY PIPE IN NON CONDITIONED SPACES.


FLAG NOTES #

NOT USED

BASEMENT PLUMBING SUPPLY PLAN
SCALE: 3/16" = 1'-0"



NO.	DATE	DESCRIPTION	REVISIONS



DRAWN:	JM
DESIGNED:	JM
CHECKED:	RJ
APPROVED:	JR

PROJECT: **BRADLEY HEIGHT APARTMENTS - BUILDING A**
202 27TH AVE SE
PUYALLUP, WA 98374


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 364-3343

ROBISON ENGINEERING, INC

DATE: 2/14/2024

SHEET TITLE:
BASEMENT PLUMBING SUPPLY PLAN

SHEET NO.
P3A.01

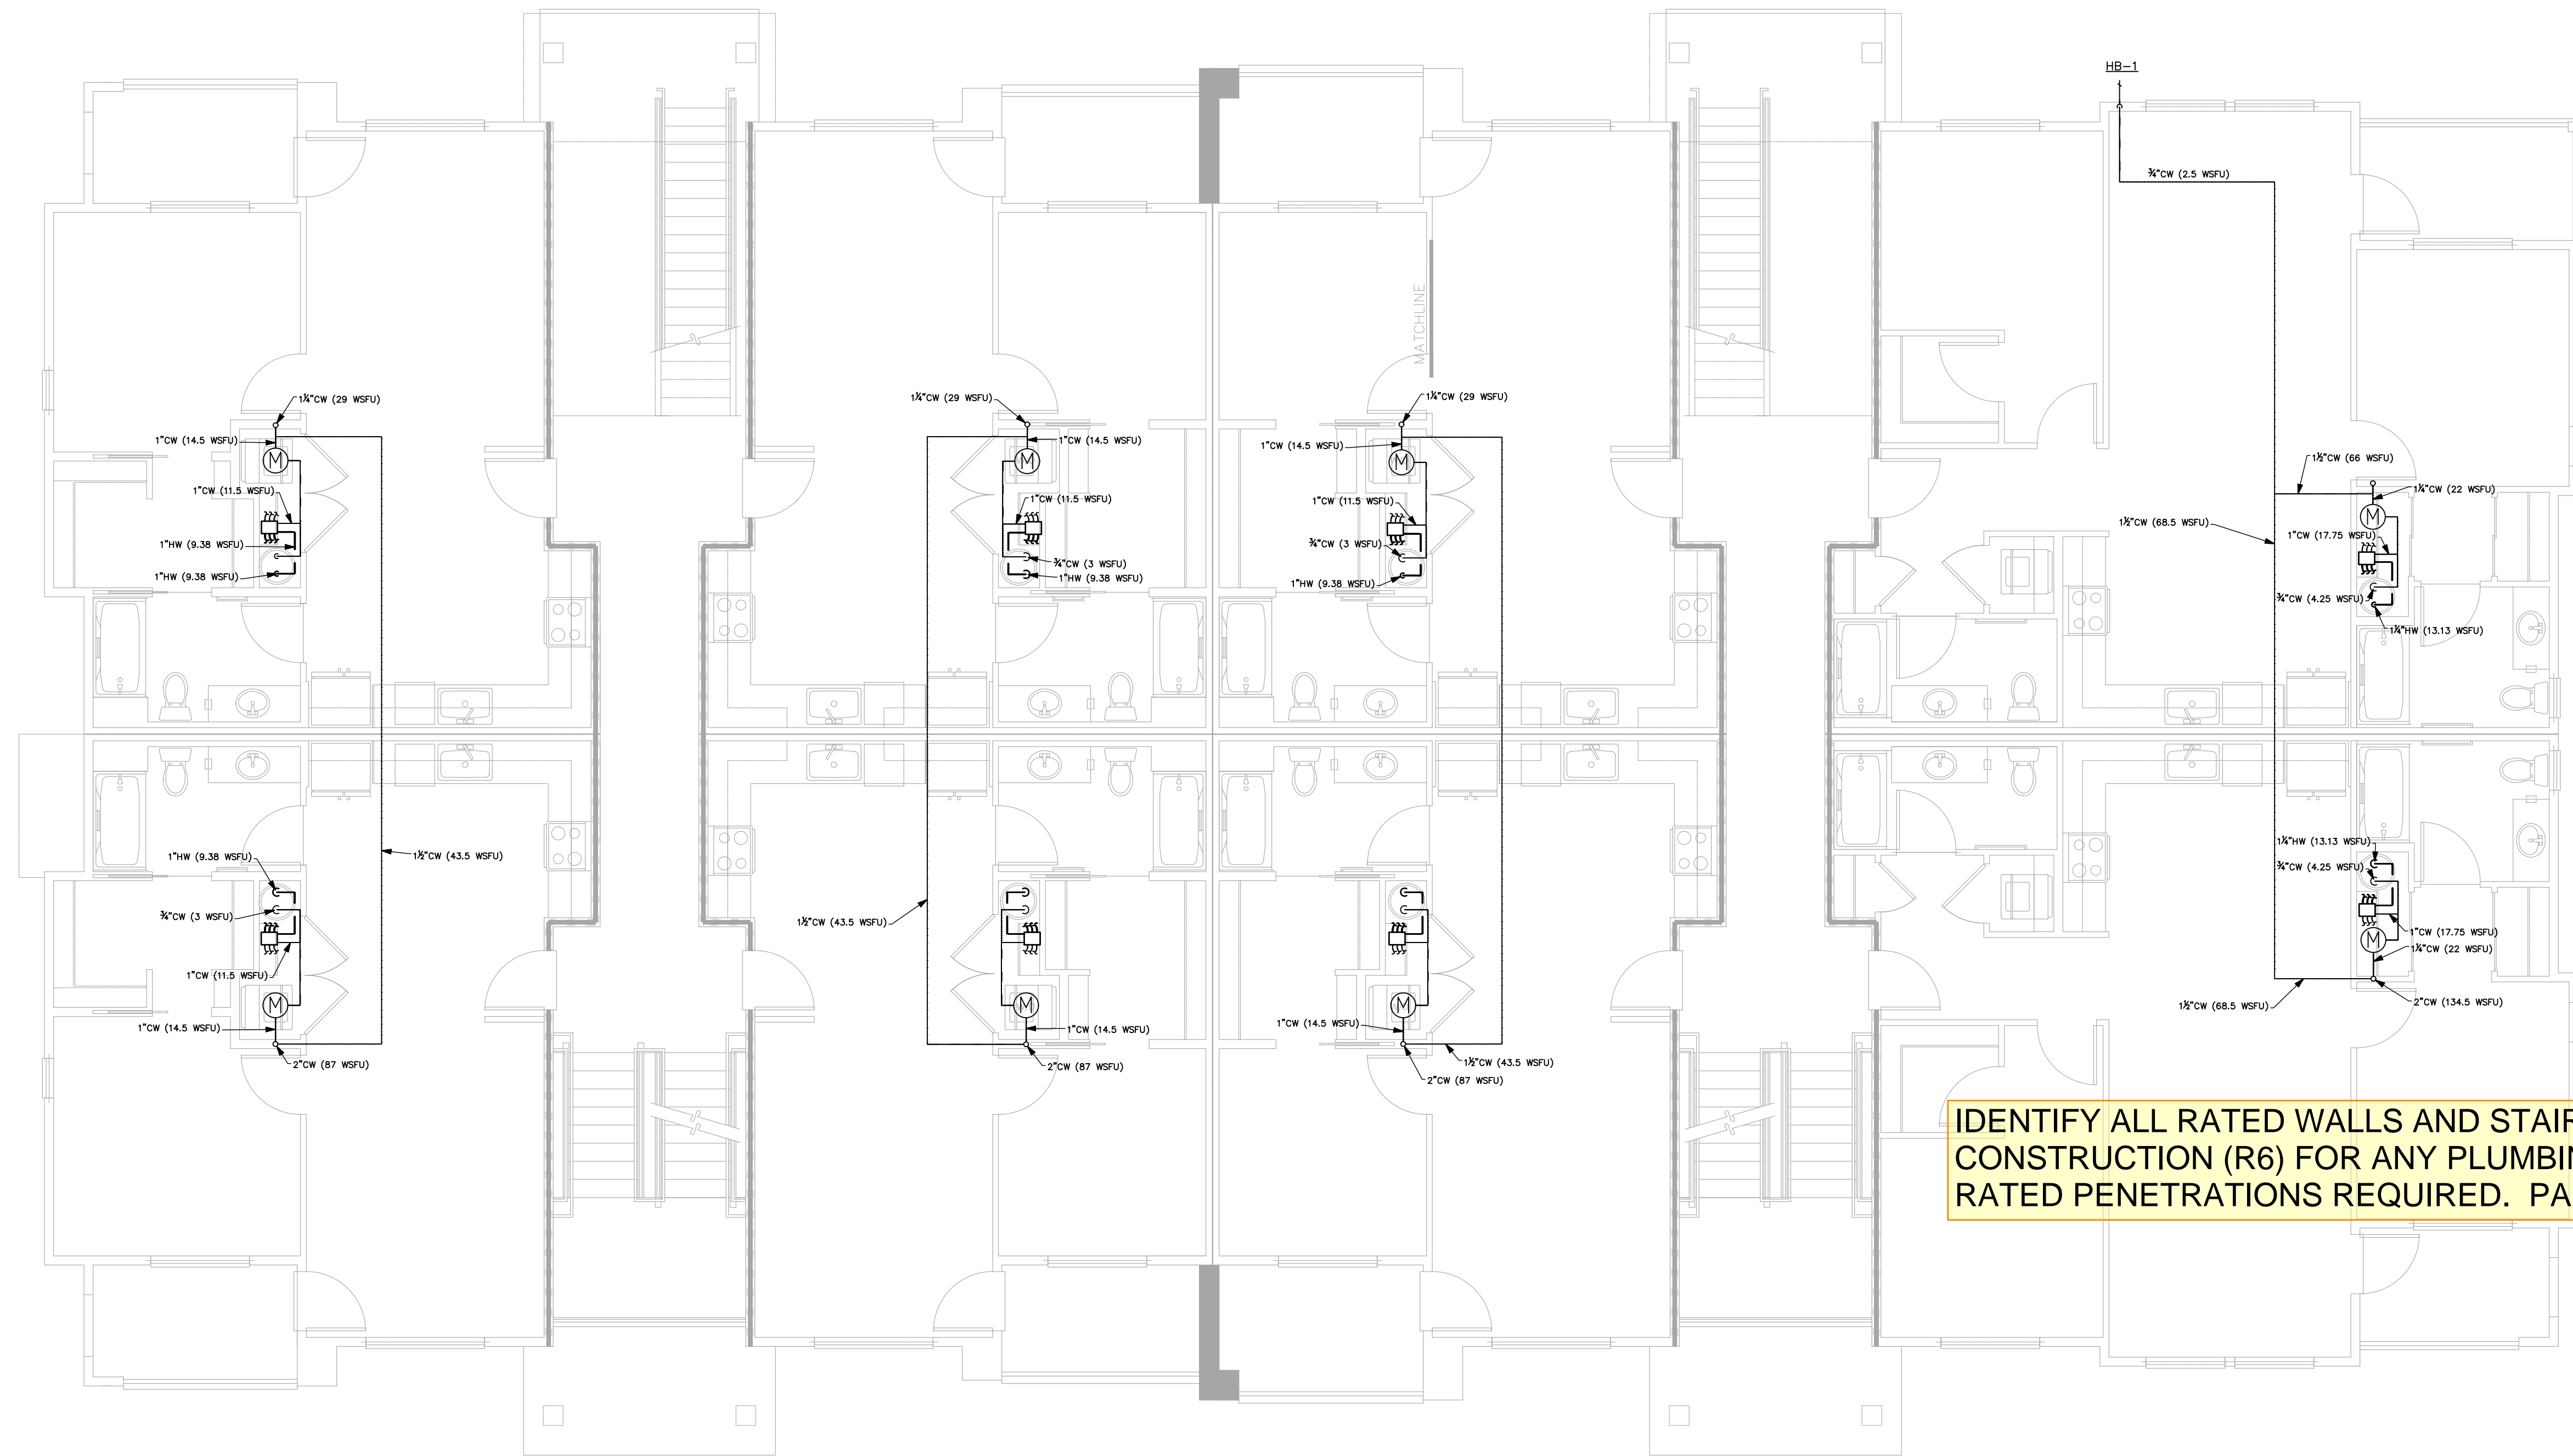


GENERAL NOTES

1. PROVIDE EXPANSION LOOPS FOR ALL WATER PIPING PER THE MANUFACTURER'S INSTRUCTIONS. SEE DETAIL 3/P7.01.
2. INSTALL HEAT TRACE ON SUPPLY PIPE IN NON CONDITIONED SPACES.


FLAG NOTES #

NOT USED

LEVEL 1 PLUMBING SUPPLY PLAN
SCALE: 3/16" = 1'-0"



NO.	DATE	DESCRIPTION	REVISIONS



DRAWN: JM	DESIGNED: JM	CHECKED: RJ	APPROVED: JR
-----------	--------------	-------------	--------------

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A
202 27TH AVE SE
PUYALLUP, WA 98374


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206/364-3343

ROBISON ENGINEERING, INC.

DATE: 2/14/2024

SHEET TITLE:
LEVEL 1
PLUMBING
SUPPLY PLAN

SHEET NO.
P3A.02

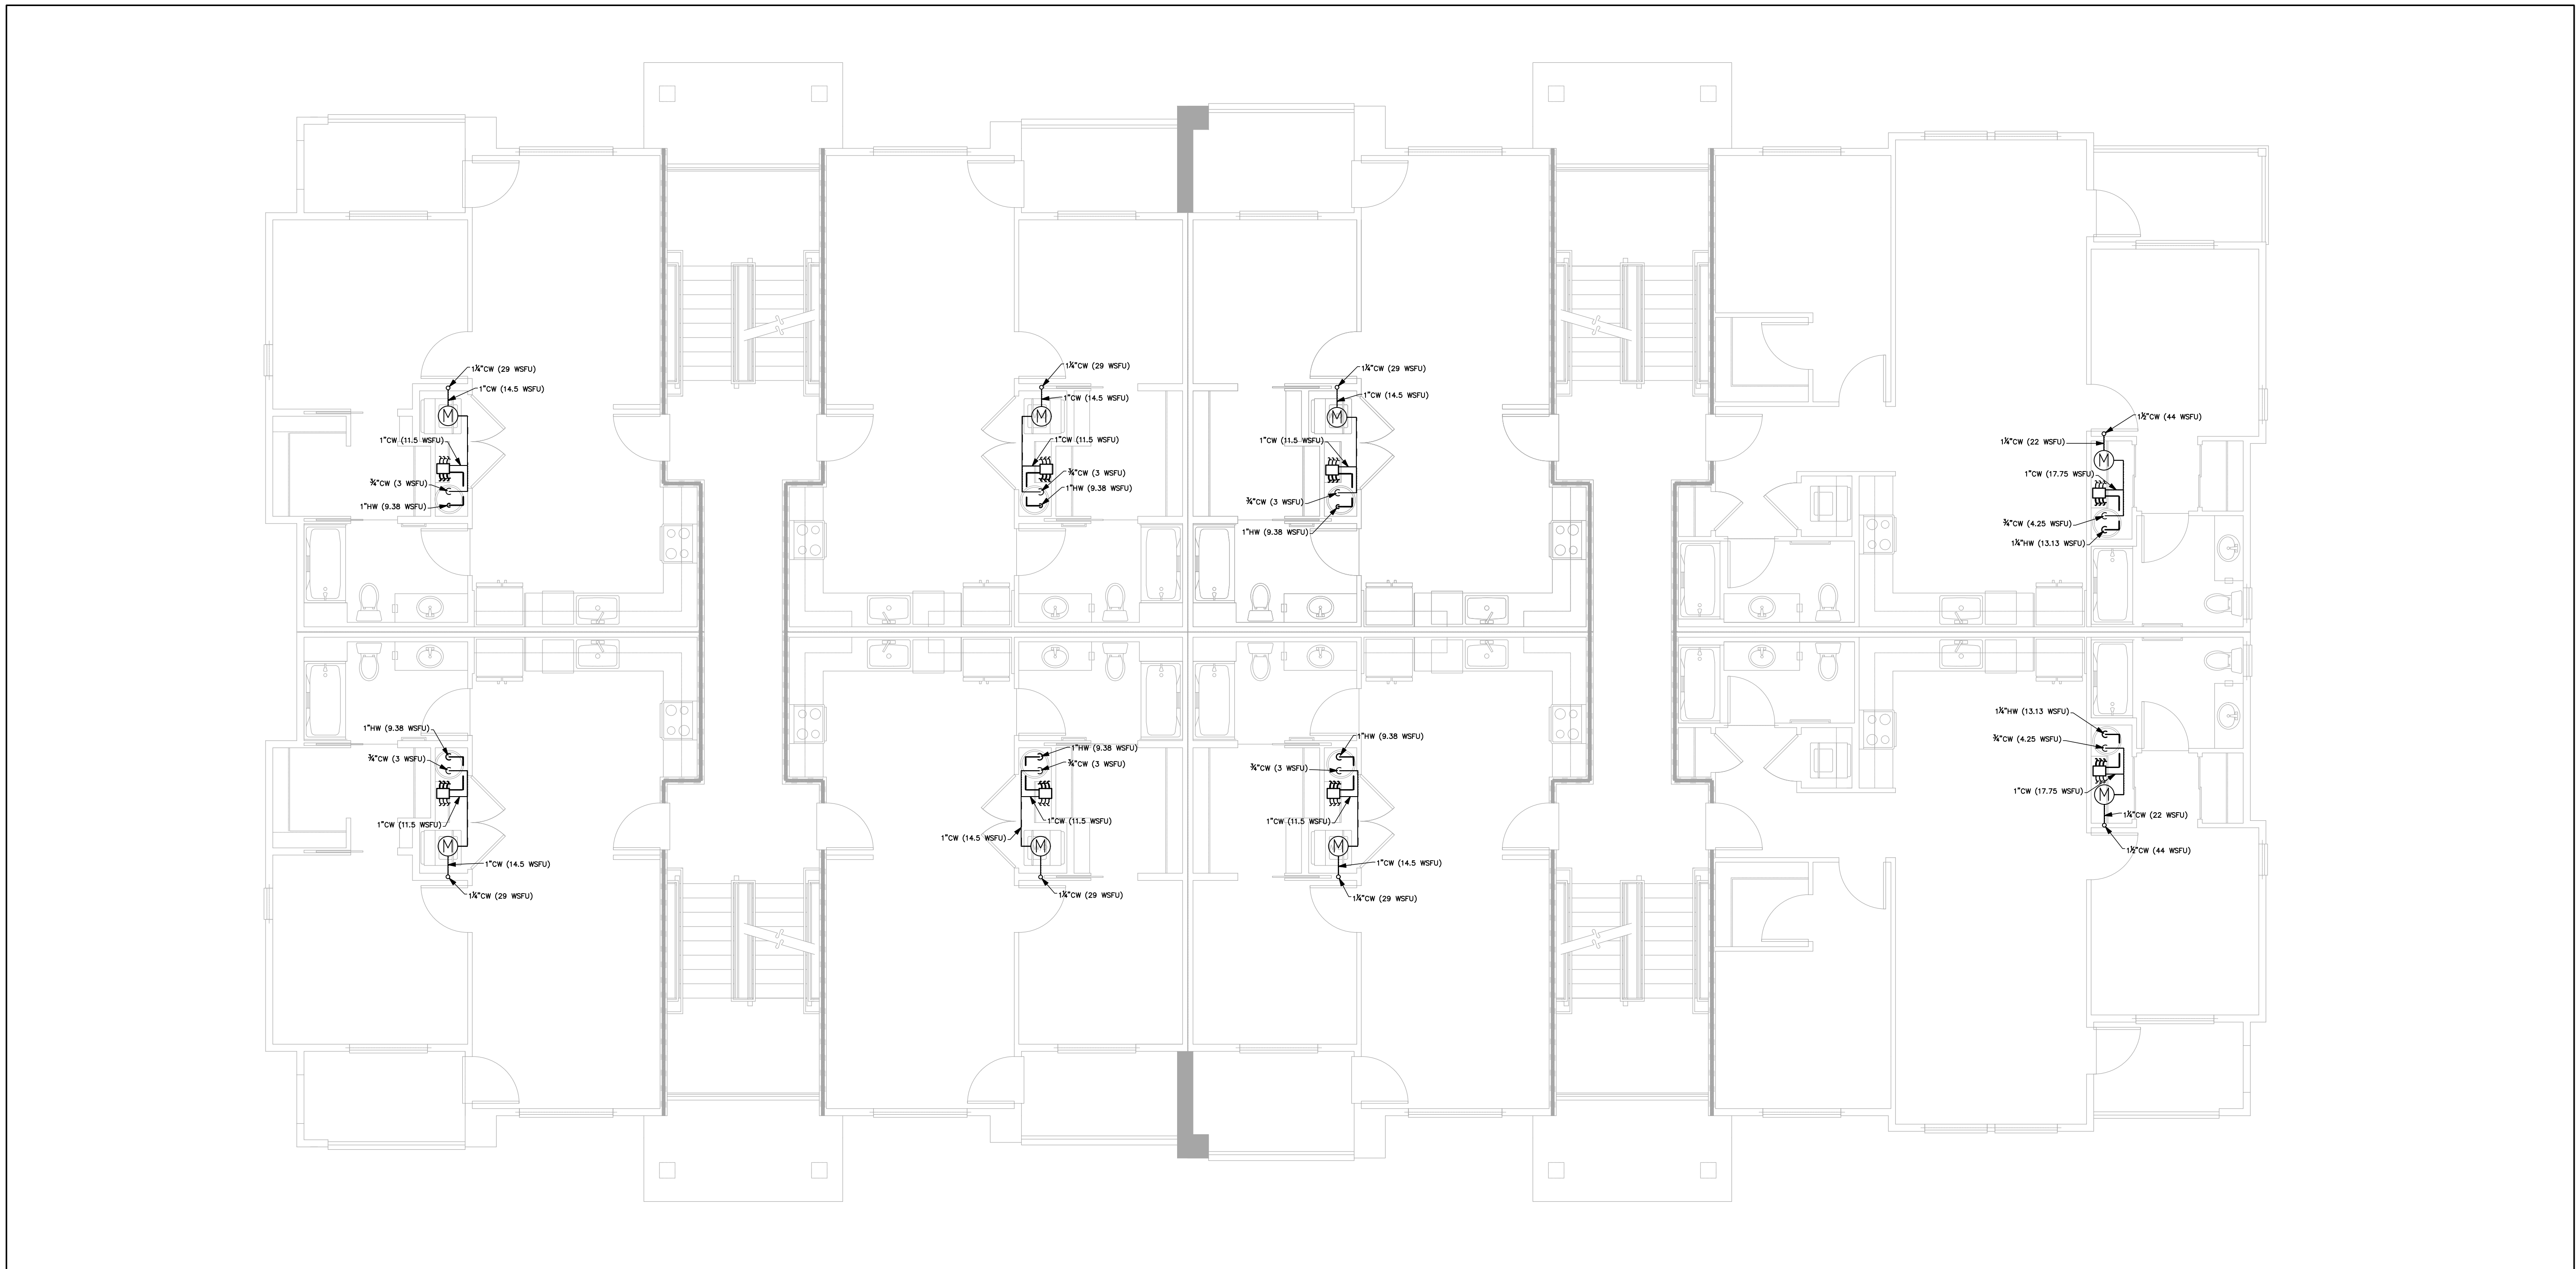


GENERAL NOTES

1. PROVIDE EXPANSION LOOPS FOR ALL WATER PIPING PER THE MANUFACTURER'S INSTRUCTIONS. SEE DETAIL 3/P7.01.
2. INSTALL HEAT TRACE ON SUPPLY PIPE IN NON CONDITIONED SPACES.


FLAG NOTES

NOT USED

LEVEL 2 PLUMBING SUPPLY PLAN
 SCALE: 3/16" = 1'-0"



NO.	DATE	DESCRIPTION	REVISIONS



DRAWN:	JM
DESIGNED:	JM
CHECKED:	RJ
APPROVED:	JR

PROJECT: **BRADLEY HEIGHT APARTMENTS - BUILDING A**
 202 27TH AVE SE
 PUYALLUP, WA 98374


19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343

ROBISON ENGINEERING, INC

DATE: 2/14/2024

SHEET TITLE:
**LEVEL 2
 PLUMBING
 SUPPLY PLAN**

SHEET NO.
P3A.03

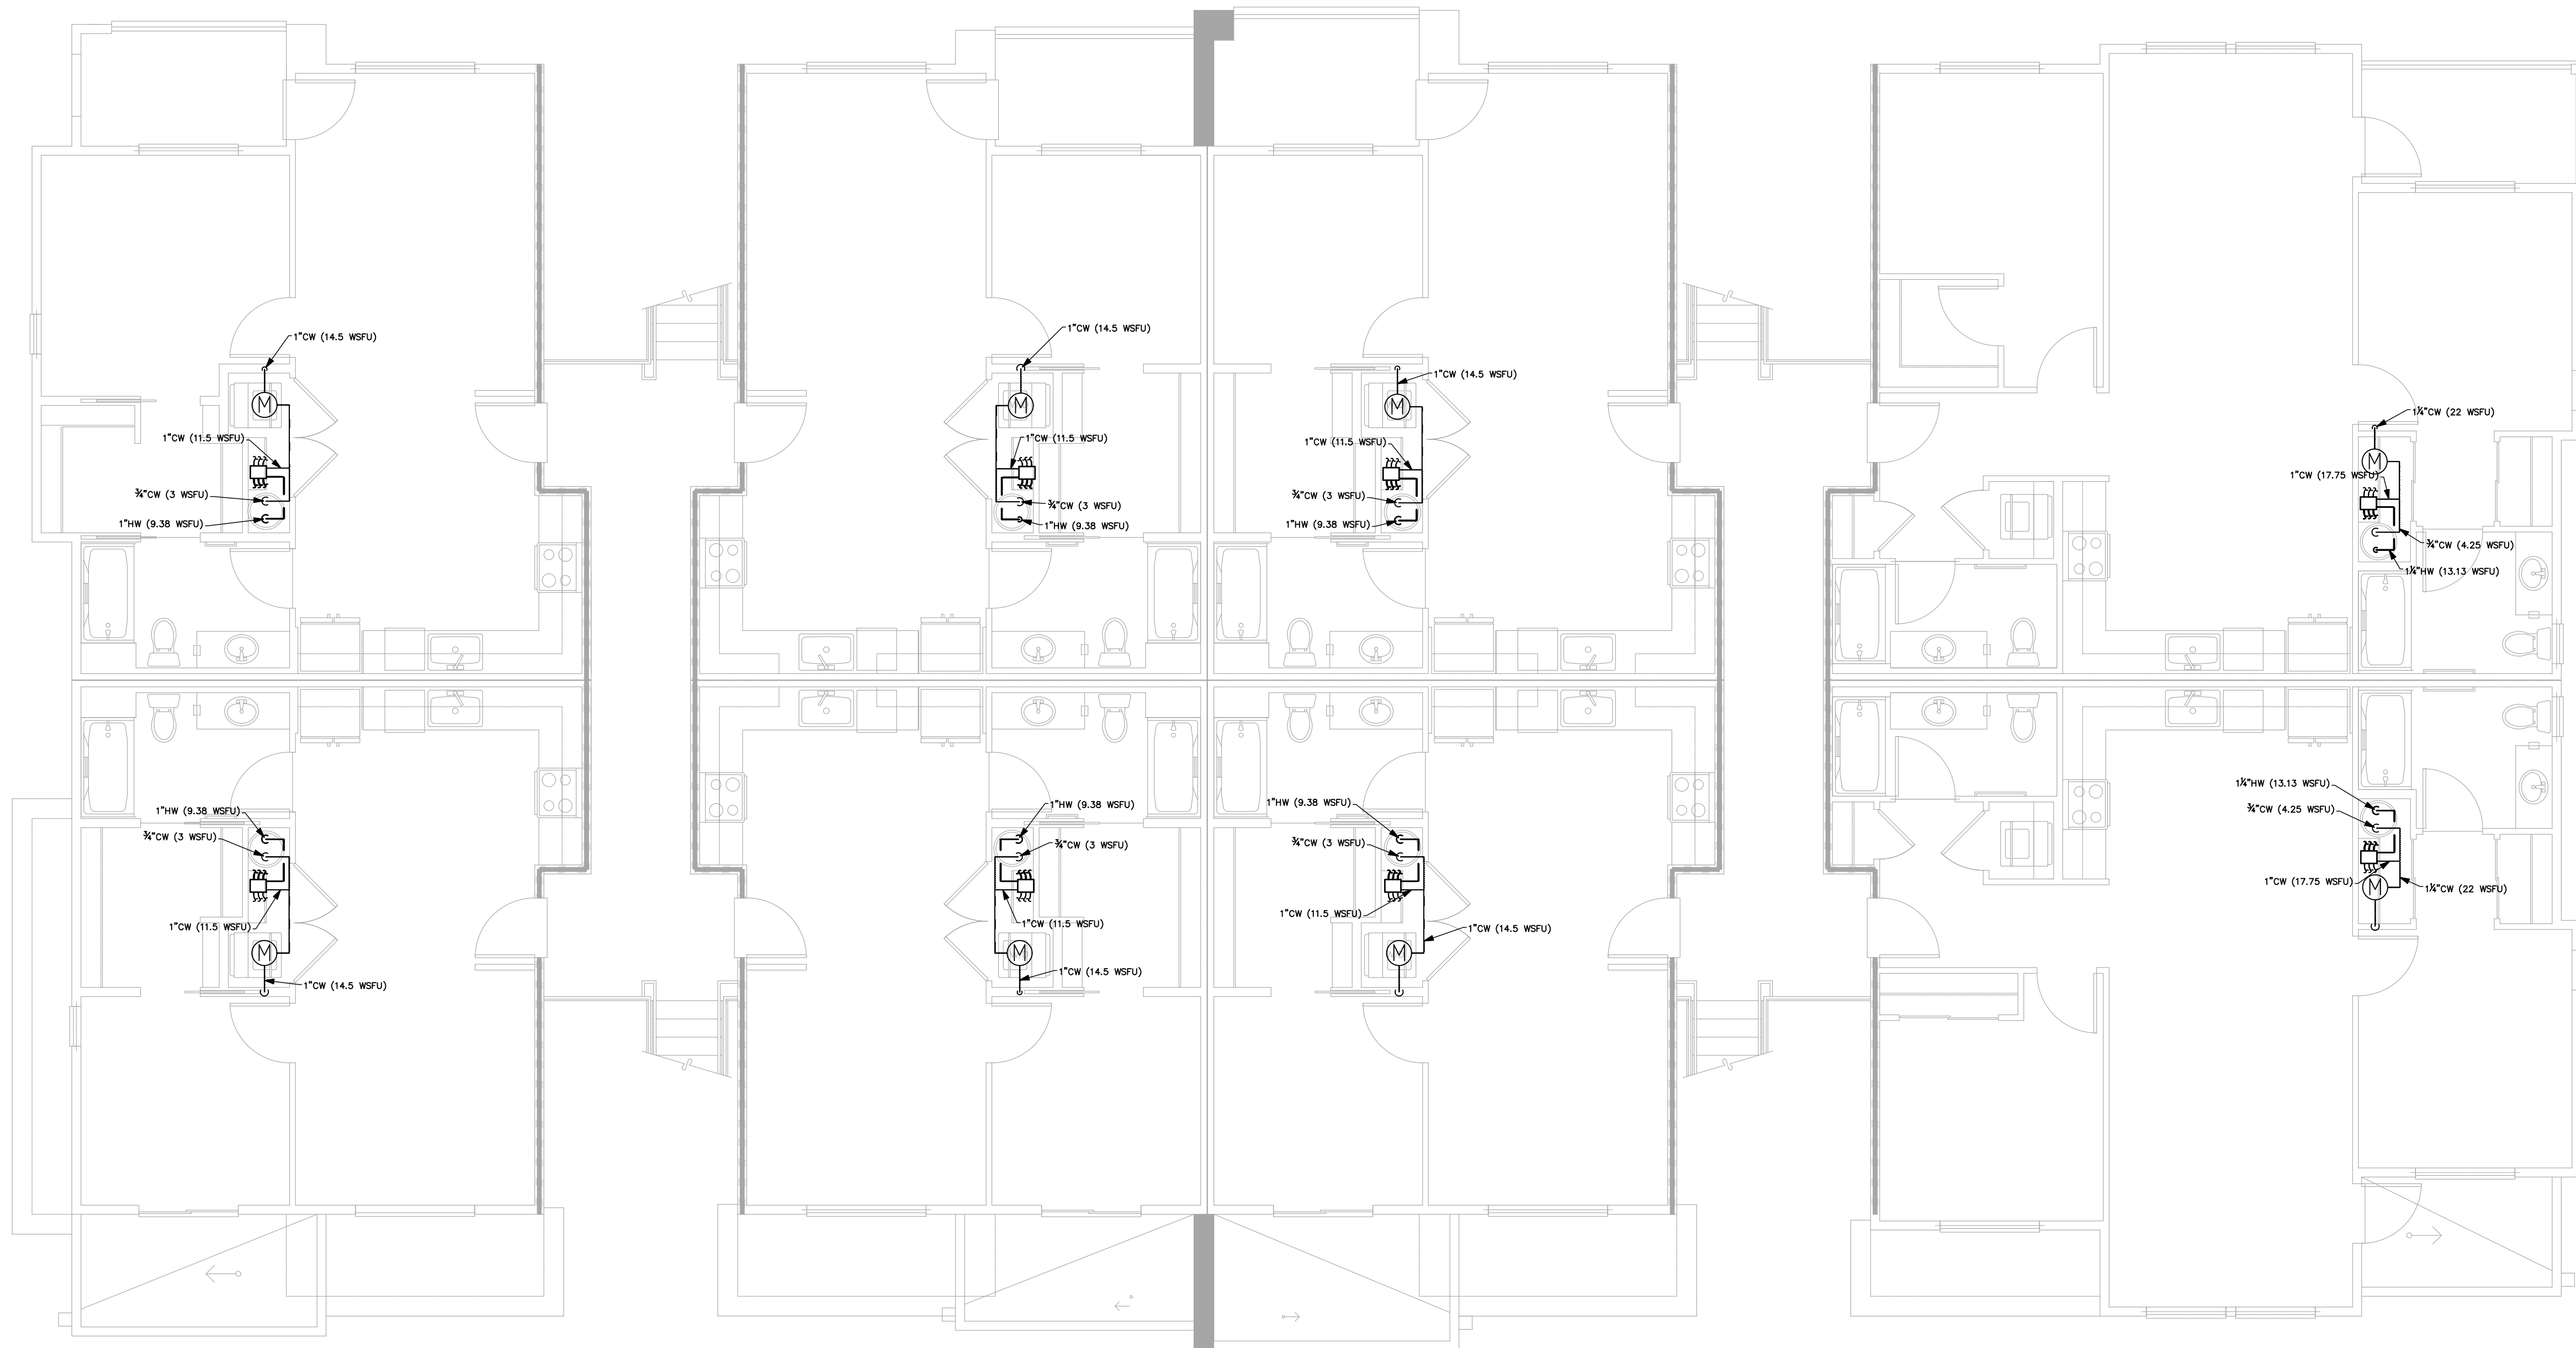

GENERAL NOTES


1. PROVIDE EXPANSION LOOPS FOR ALL WATER PIPING PER THE MANUFACTURER'S INSTRUCTIONS. SEE DETAIL 3/P7.01.
2. INSTALL HEAT TRACE ON SUPPLY PIPE IN NON CONDITIONED SPACES.

FLAG NOTES #



NOT USED

PROVIDE WASTE RISER DIAGRAMS FROM BASEMENT TO ROOF FOR CLARIFICATION FOR BUILDING A. PAGE P3A.04

LEVEL 3 PLUMBING SUPPLY PLAN
SCALE: 3/16" = 1'-0"



NO.	DATE	DESCRIPTION	REVISIONS

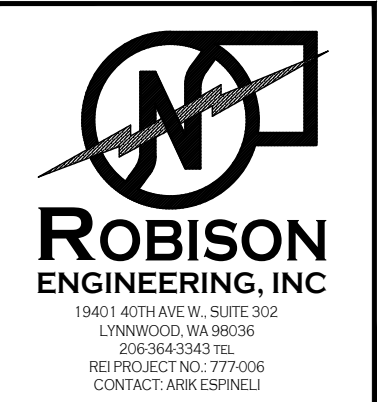

DRAWN:	JM	DESIGNED:	JM	CHECKED:	RJ	APPROVED:	JR
--------	----	-----------	----	----------	----	-----------	----

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A
202 27TH AVE SE
PUYALLUP, WA 98374


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 836-0367

ROBISON ENGINEERING, INC.


DATE: 2/14/2024

SHEET TITLE:
LEVEL 3 PLUMBING SUPPLY PLAN


SHEET NO.
P3A.04

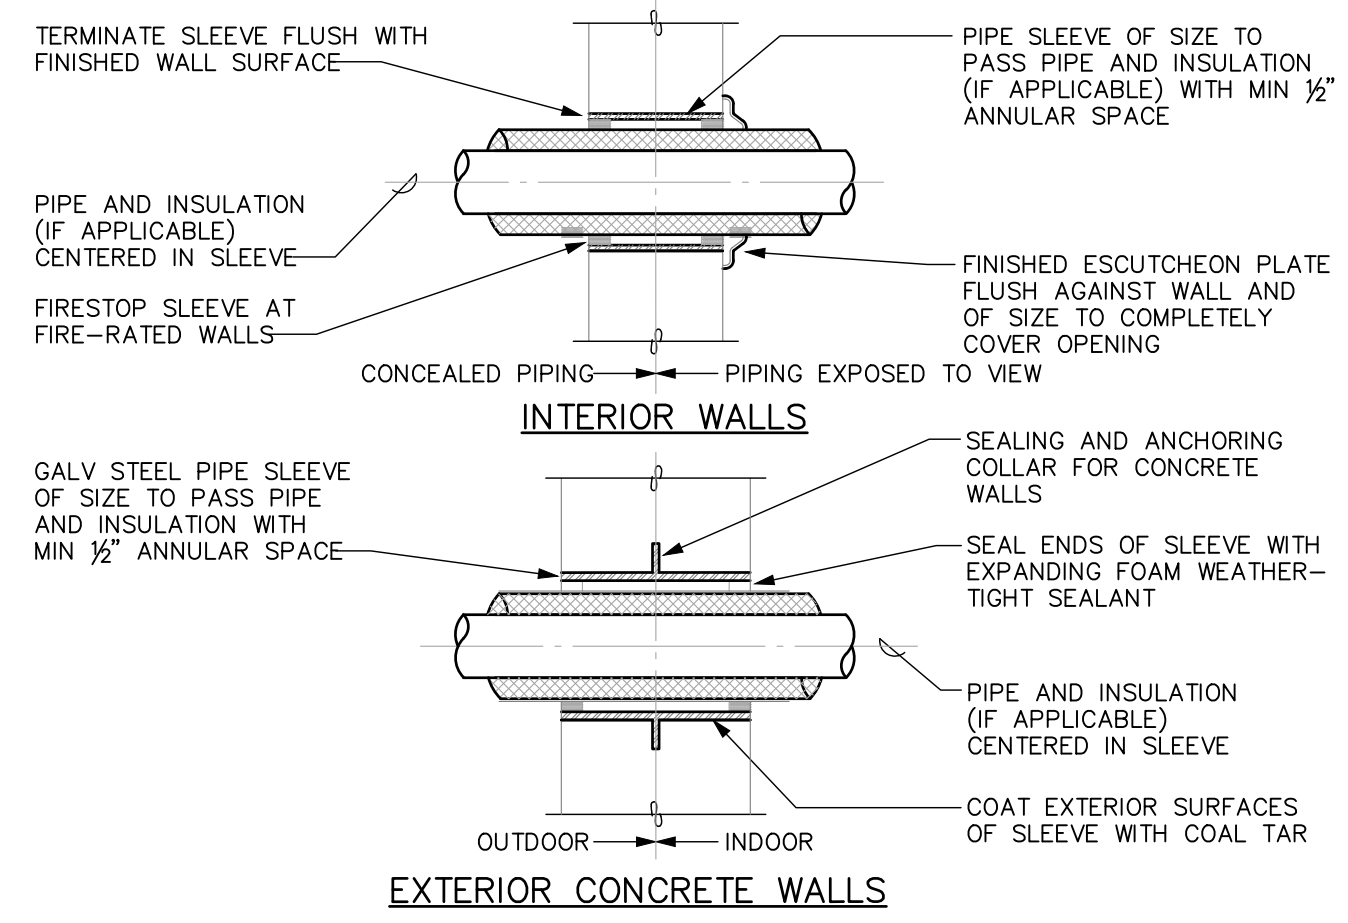


PIPE SLEEVES THROUGH WALLS
 SCALE: NONE

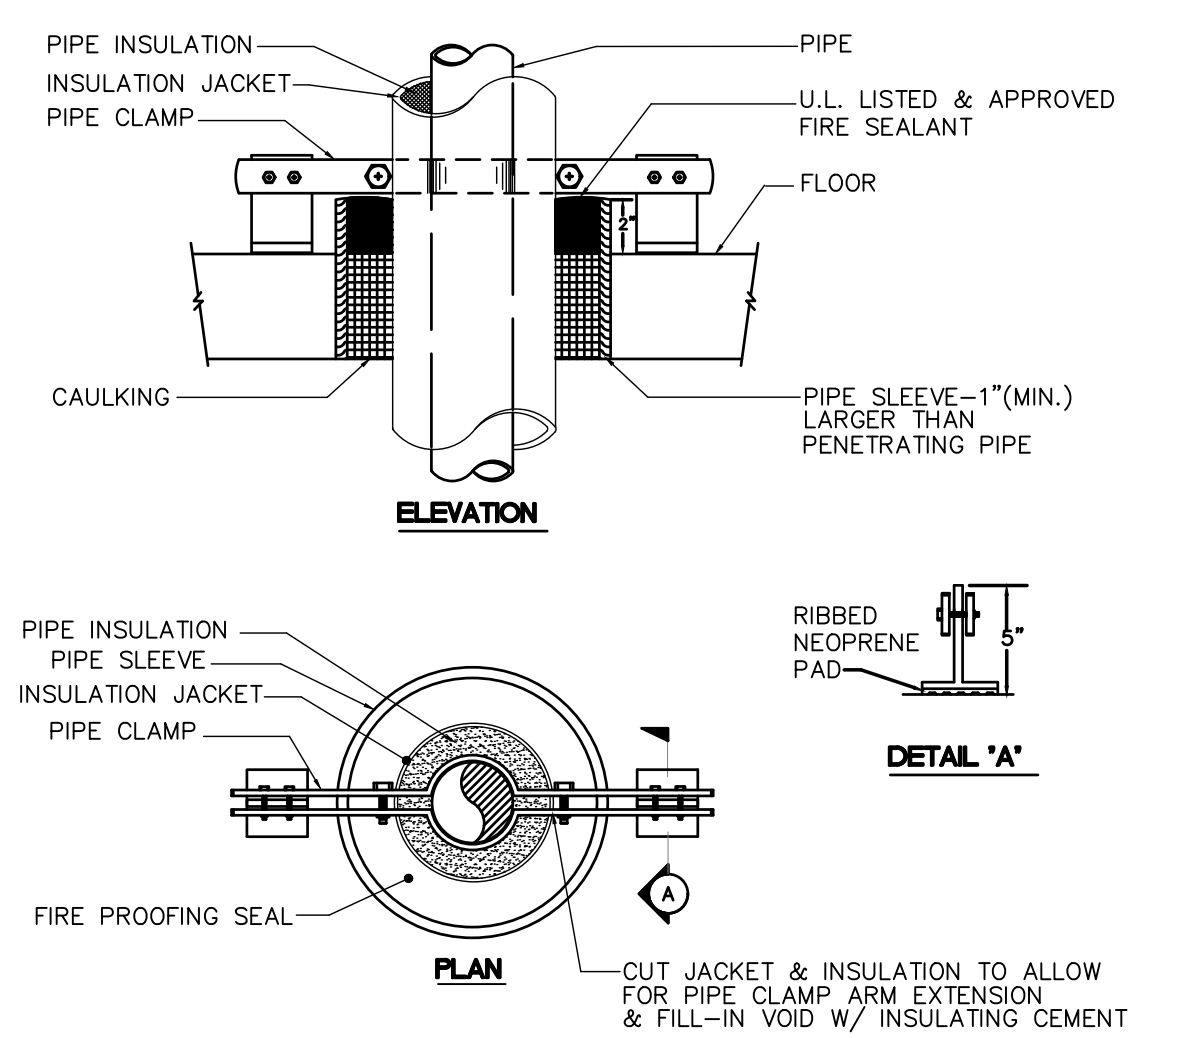


RISER PIPE SUPPORT
 SCALE: NONE

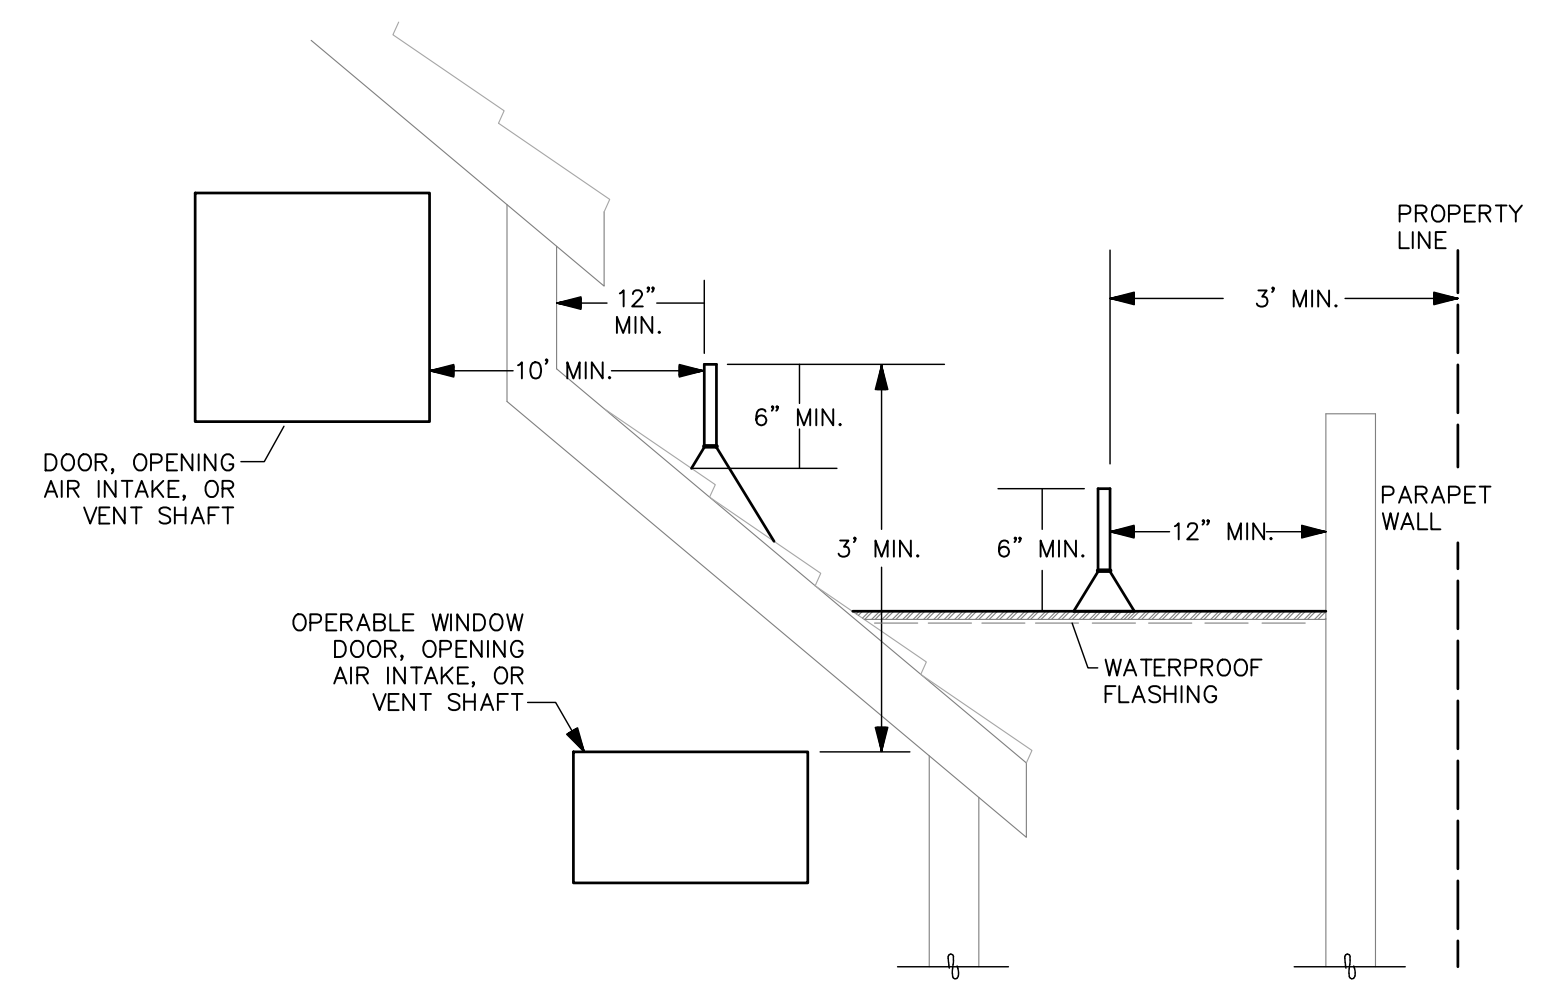


VENT TERMINATION CLEARANCE
 SCALE: NONE

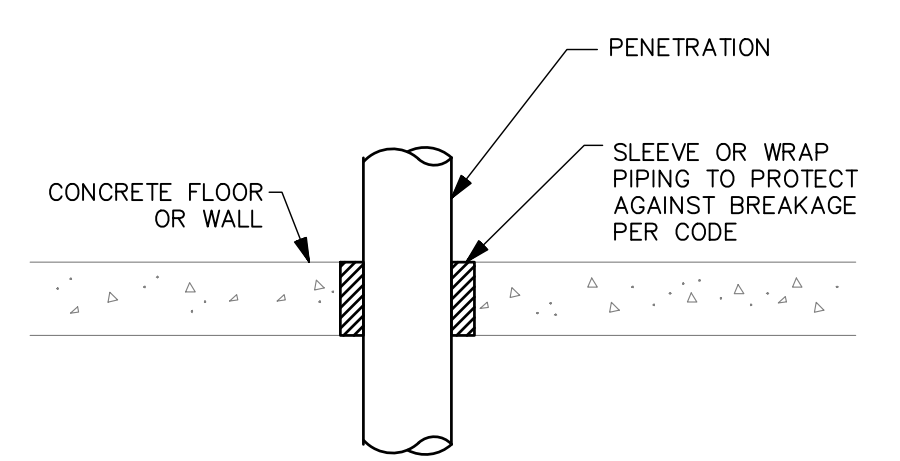

PIPE SLAB PENETRATION
 SCALE: NONE

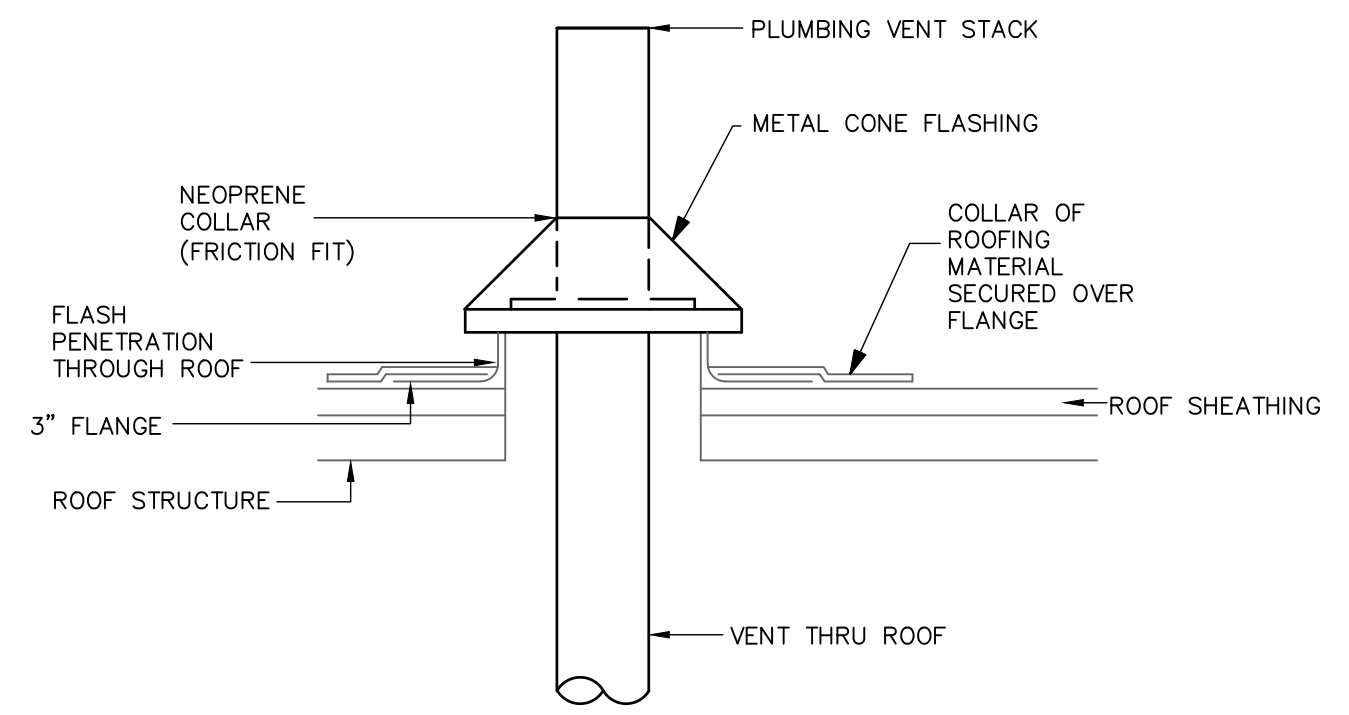

VENT THROUGH ROOF
 SCALE: NONE

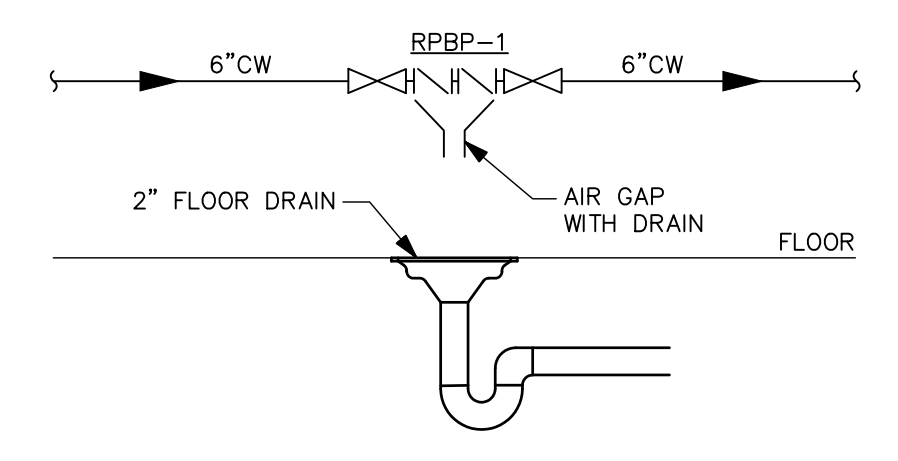


REDUCED PRESSURE BACKFLOW PREVENTER
 SCALE: NONE

EQUIPMENT SCHEDULE


- WATER METERS (NEXT CENTURY MULTI-JET WATER METER MODEL M201CH, 3/4")
 TRANSCIVER: WIRELESS METERING DATA TRANSCIVER DUAL INPUT WITH DISPLAY, WITH BATTERIES. TEHAMA WIRELESS MODEL TW-165A-PP.
 WIRELESS REPEATERS: TEHAMA COMPATIBLE REPEATERS; QUANTITY TWO. TEHAMA WIRELESS TW-191X.
 UDATA CONCENTRATING ACCESS POINT (DCAP):
 • DCAP TO BE INSTALLED ON MAIN COMM/DATA BOARD AND POWER SUPPLY PLUGGED INTO RECEPTACLE.
 • PROVIDE ETHERNET OR WIFI ACCESS FOR INTERNET ACCESS TO DCAP.

NOTES:

1. PROVIDE COLD WATER METER AND REMOTE TRANSCIVER FOR EACH APARTMENT.
2. SECURE METER TO FLOOR/CEILING ASSEMBLY.
3. REFER TO P5 SERIES FOR PIPE SIZES.
4. TRANSITION TO PEX PIPING WITHIN EACH UNIT.

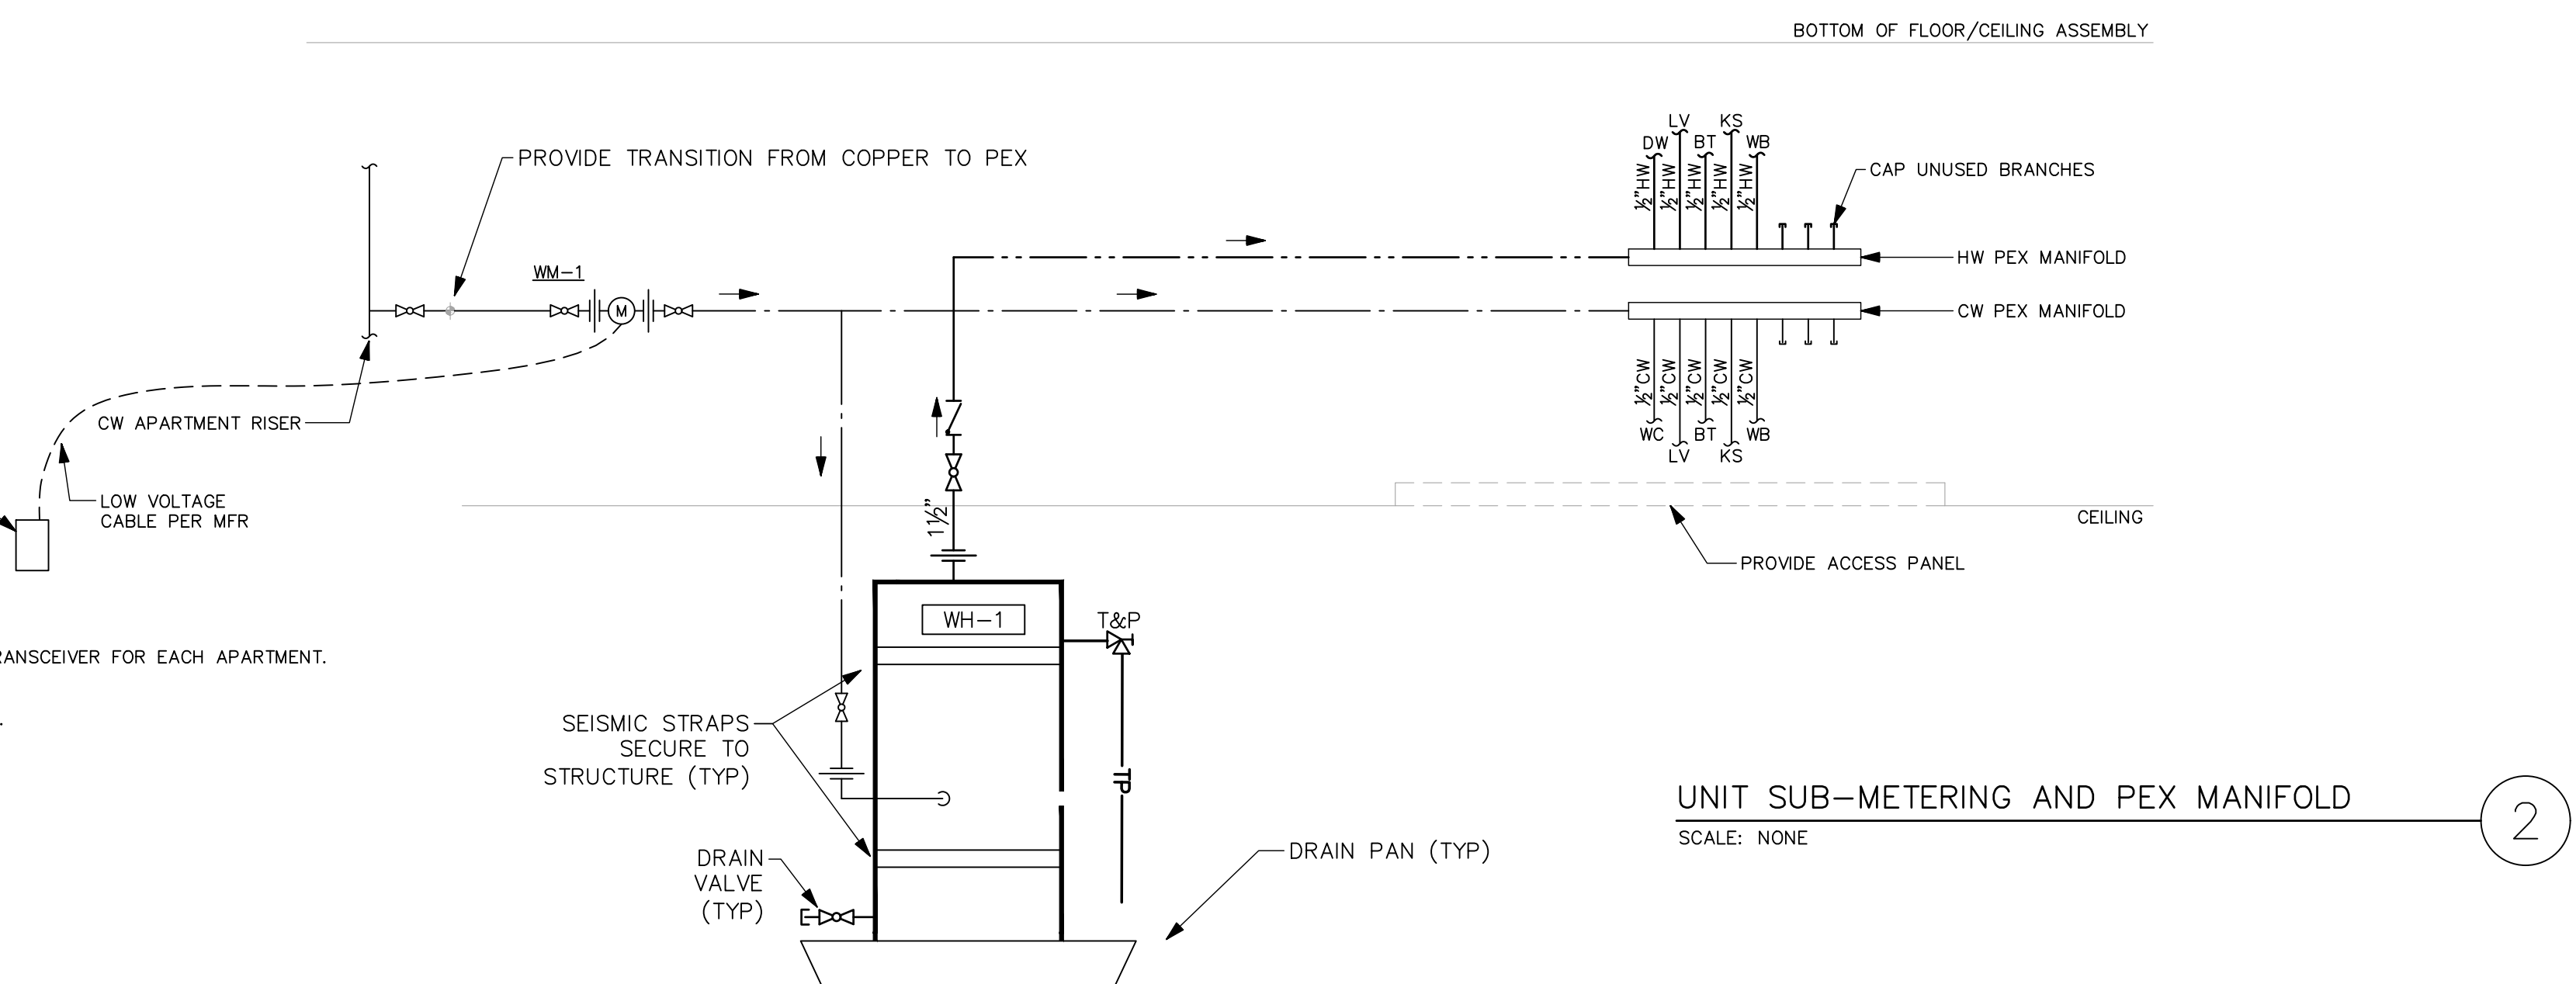

UNIT SUB-METERING AND PEX MANIFOLD
 SCALE: NONE

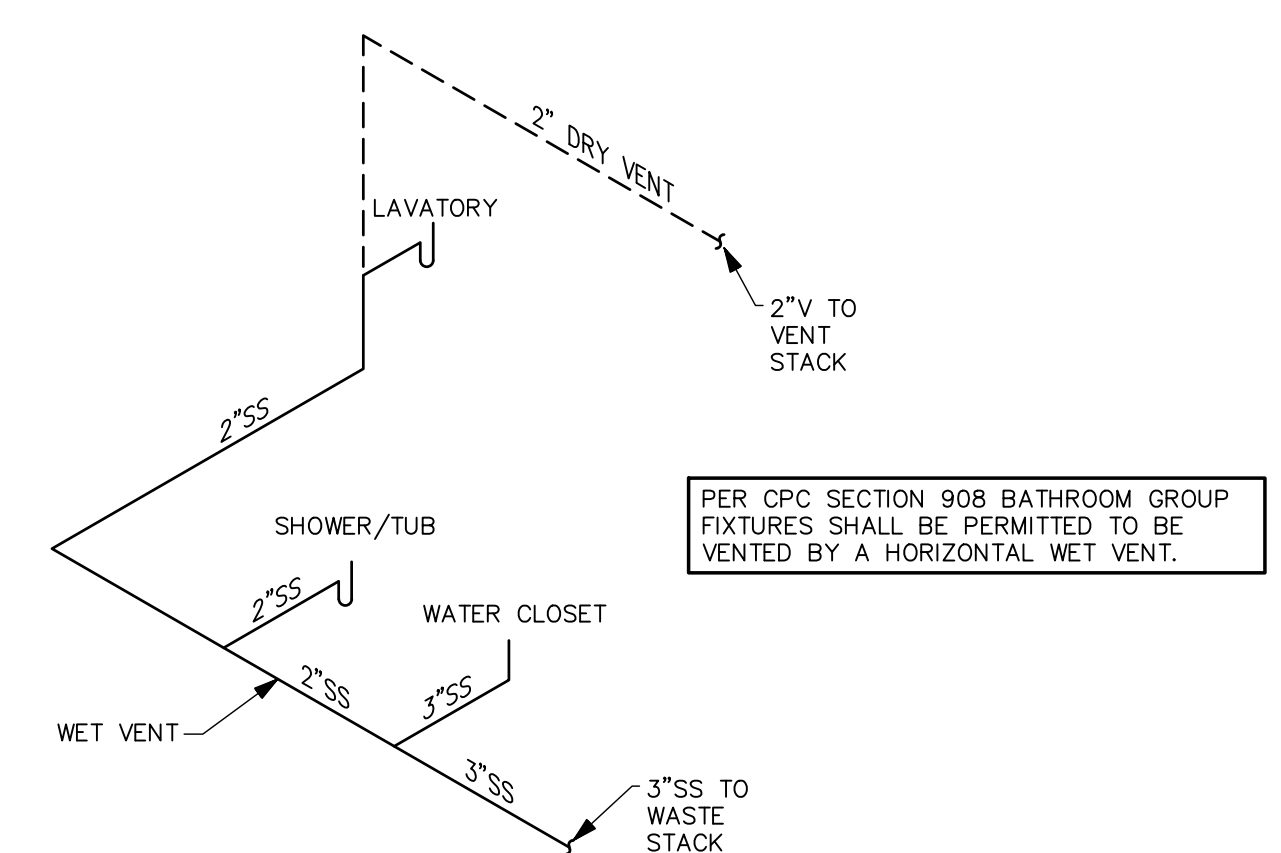

HORIZONTAL WET VENTING
 SCALE: NONE

NO.	DATE	DESCRIPTION	REVISIONS

ROBISON ENGINEERING, INC.
 19401 40TH AVE W. SUITE 302
 LYNNWOOD, WA 98036
 206-864-8381
 REG. PROJECT NO. 7771006
 CONTACT: AIME ESPINELLI

DRAWN:	JM
DESIGNED:	JM
CHECKED:	RJ
APPROVED:	JR

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A
 202 27TH AVE SE
 PUYALLUP, WA 98374


19401 40TH AVE W. SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 364-3343

ROBISON ENGINEERING, INC.


DATE: 2/14/2024

SHEET TITLE: DETAILS


SHEET NO. P7A.00

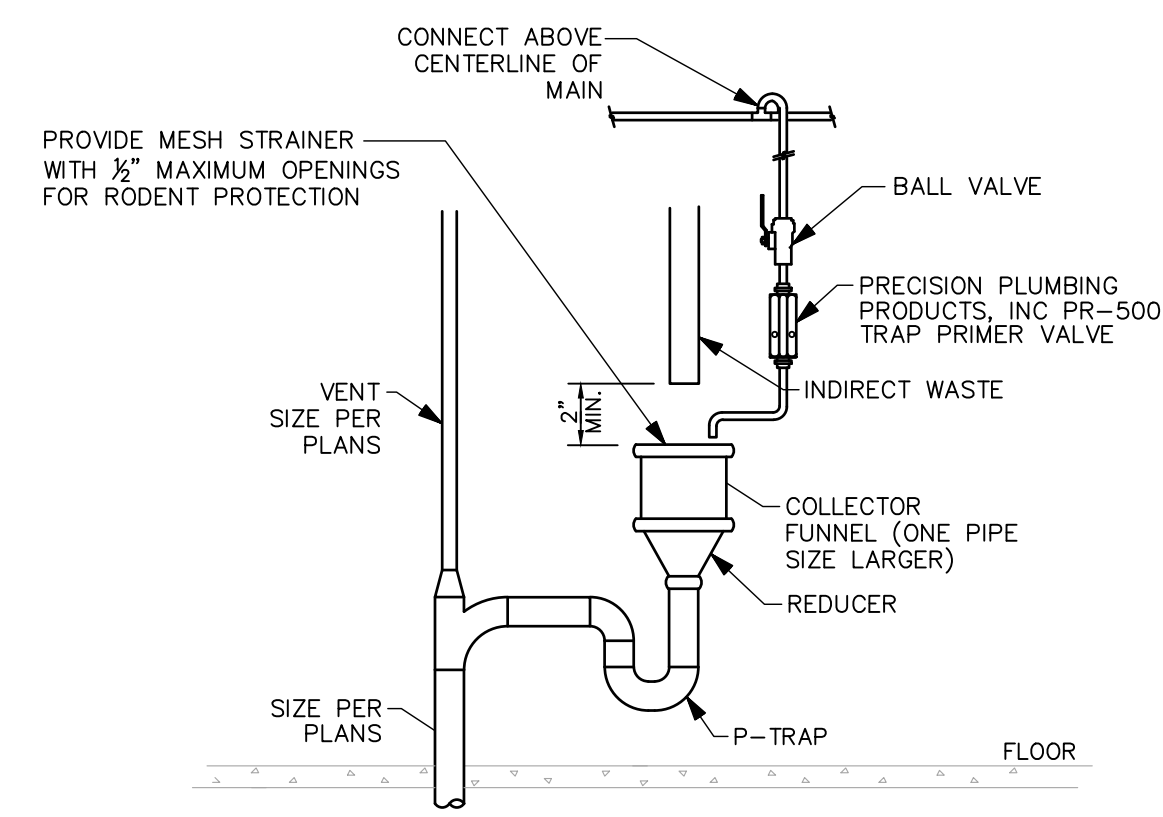


HUB DRAIN
SCALE: NONE

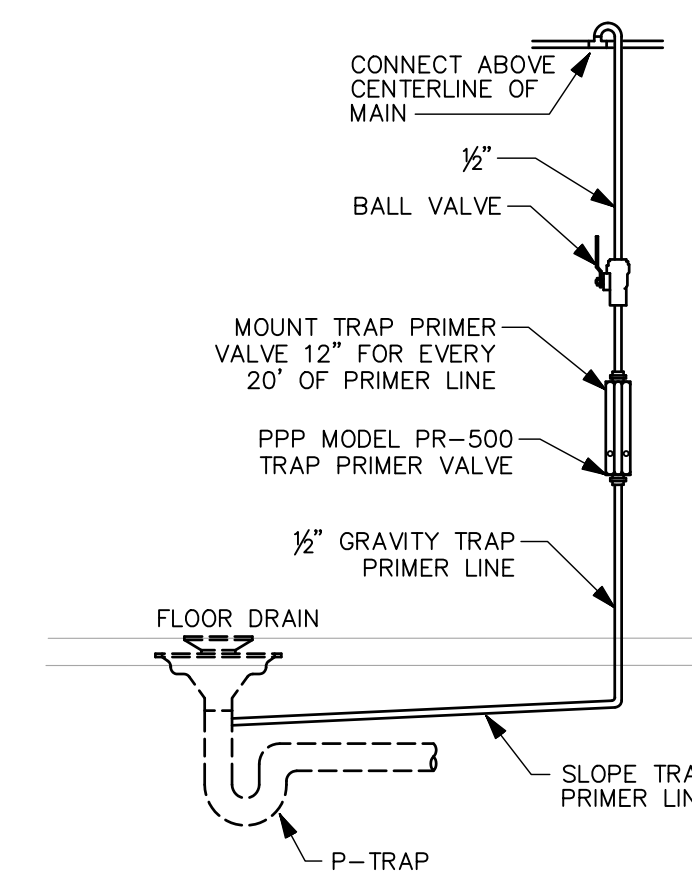


TRAP PRIMER
SCALE: NONE

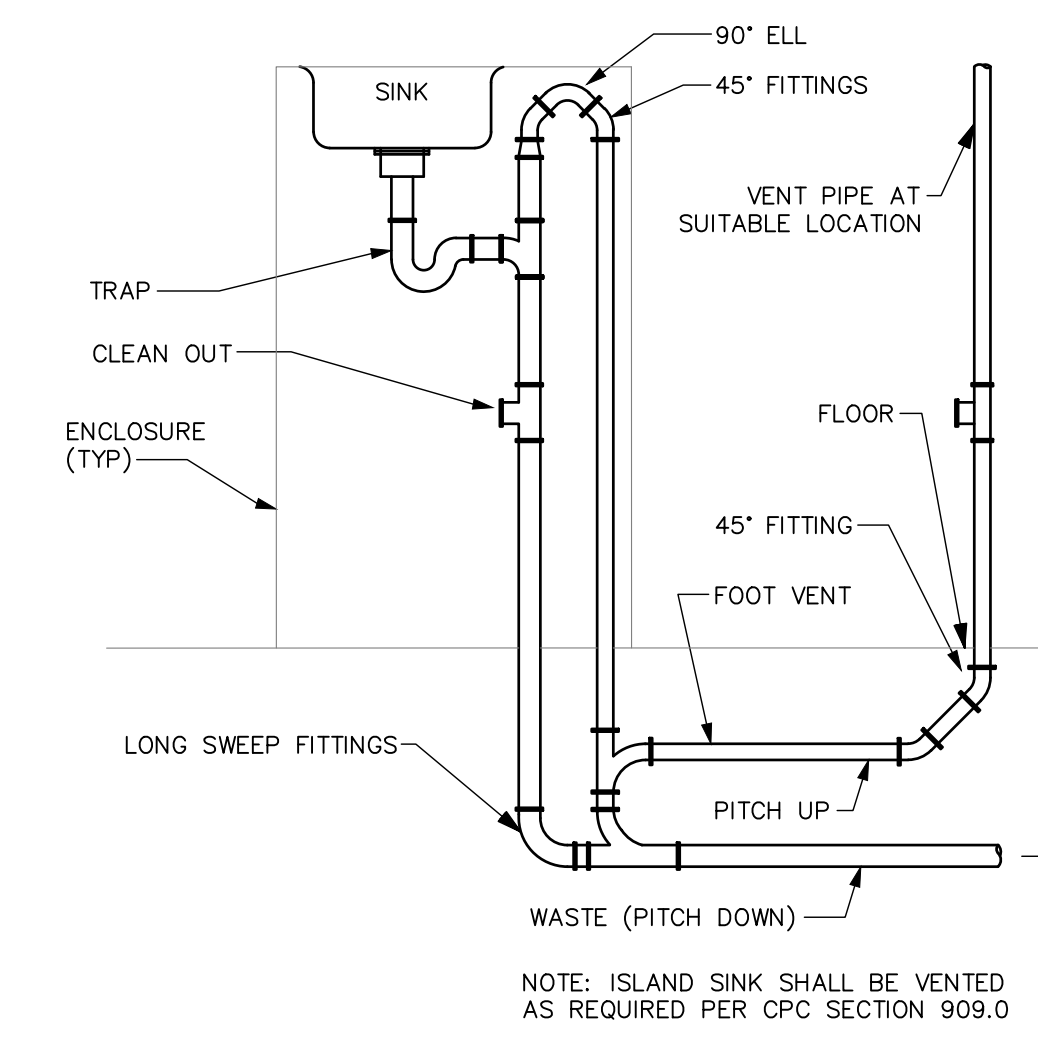


ISLAND SINK INSTALLATION
SCALE: NONE

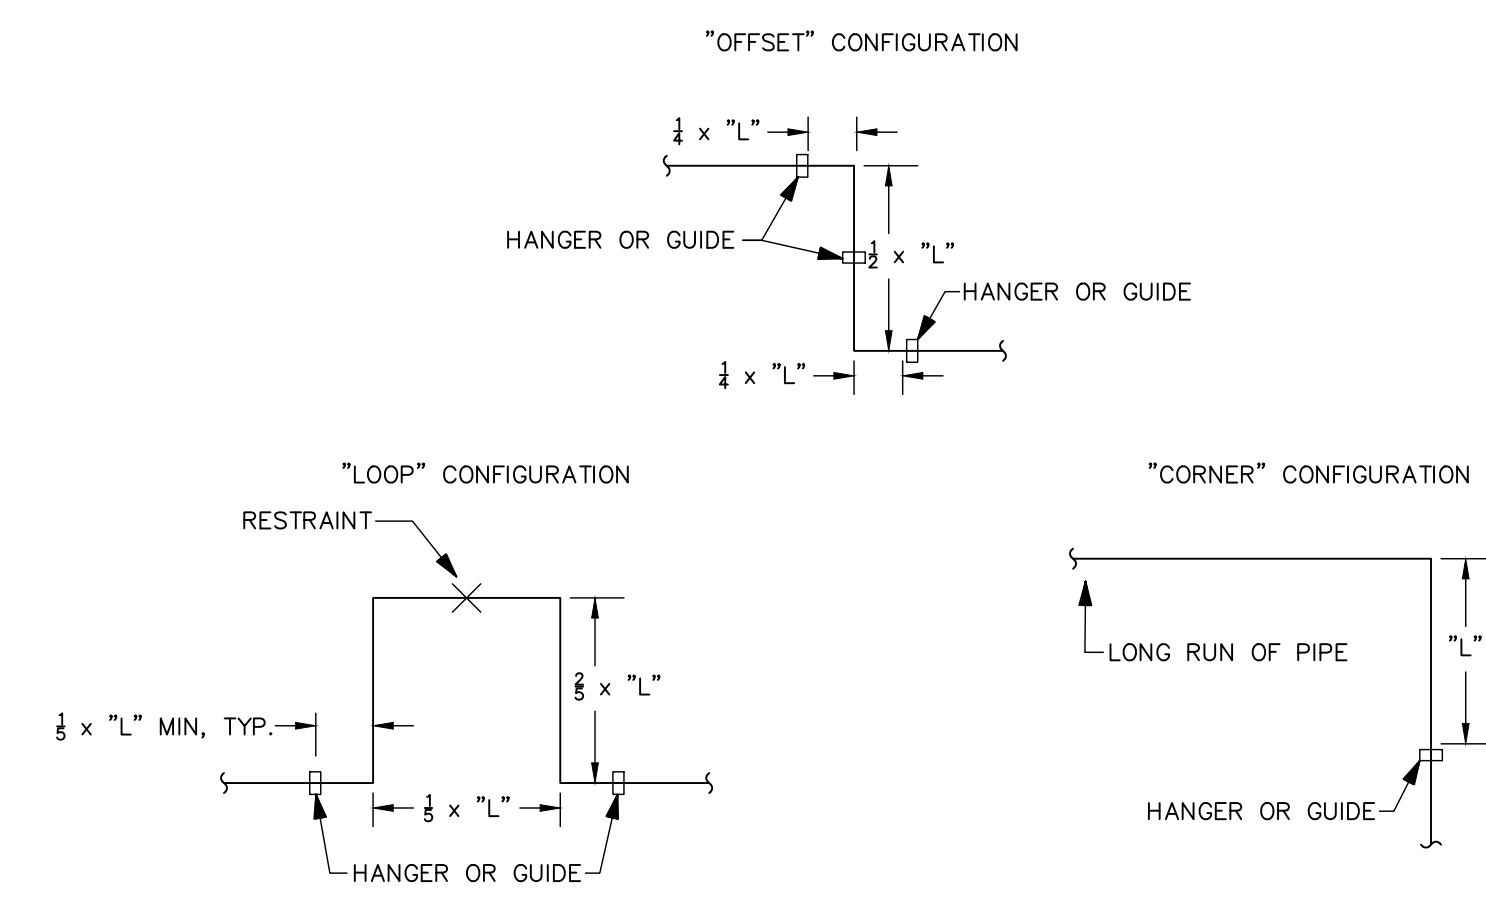


EXPANSION LOOP CONFIGURATIONS
SCALE: NONE

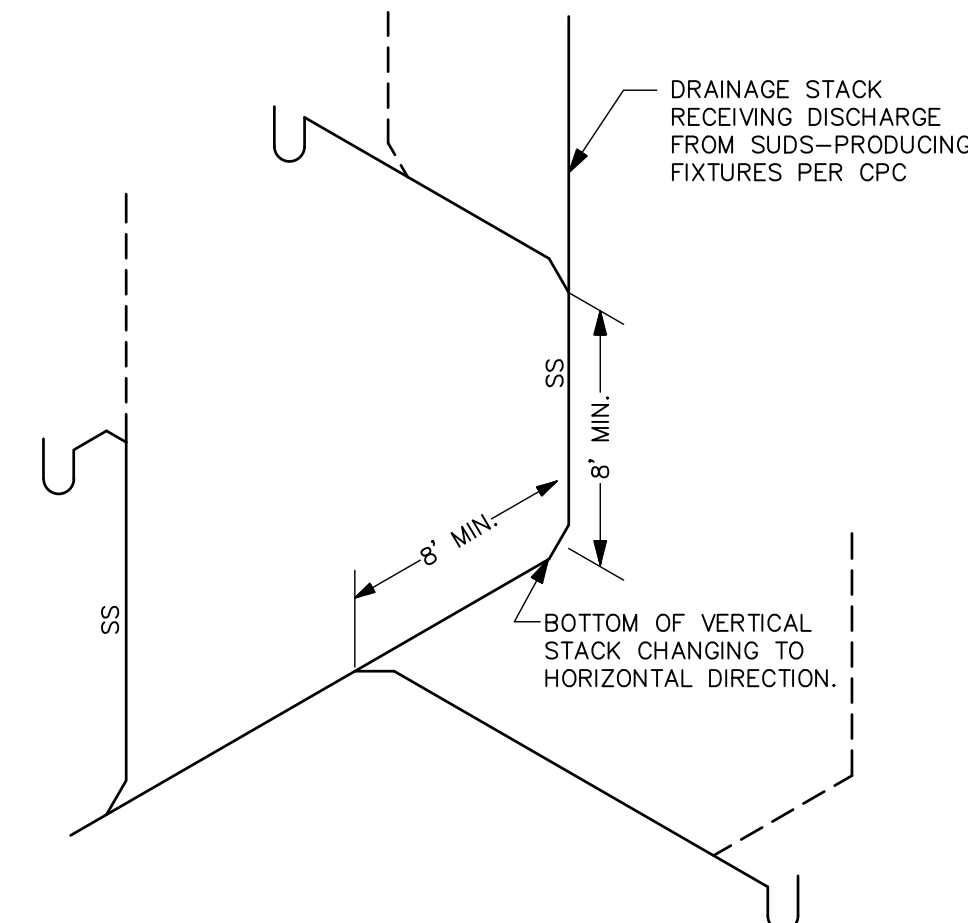

SUDS RELIEF
SCALE: NONE

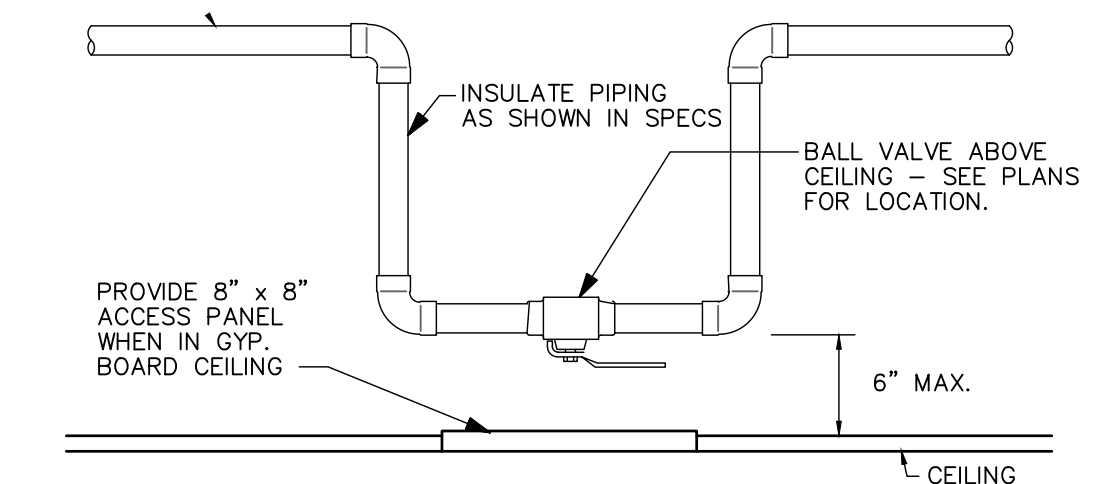

TYPICAL VALVE PLACEMENT
SCALE: NONE

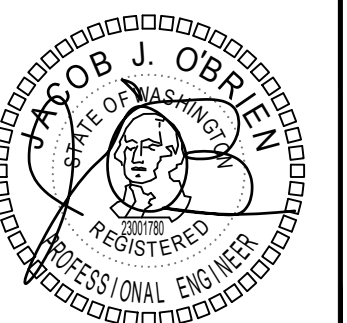

DRAWN:	JM
DESIGNED:	JM
CHECKED:	RJ
APPROVED:	JR

PROJECT: BRADLEY HEIGHT APARTMENTS - BUILDING A
202 27TH AVE SE
PUYALLUP, WA 98374

19401 40TH AVE W. SUITE 302
LYNNWOOD, WA 98036
PHONE: (206)364-3343

ROBISON ENGINEERING, INC.

DATE: 2/14/2024

SHEET TITLE: DETAILS

SHEET NO. P7A.01

NO.	DATE	DESCRIPTION	REVISIONS