

EAST TOWN CROSSING

BUILDING 'F'



ABBREVIATIONS

A.F.F.	ABOVE FINISH FLOOR
A.S.F.	ABOVE SUBFLOOR
ABC	AGGREGATE BASE COURSE
ADJ.	ADJUSTABLE
ALUM	ALUMINUM
BD	BOARD
CPT	CARPET
CLG.	CEILING
☐	CENTERLINE
CLR.	CLEAR
CLO.	CLOSET
COL.	COLUMN
CONC.	CONCRETE
CONT.	CONTINUOUS
DTL.	DETAIL
DW	DISH WASHER
D	DRYER
DBL.	DOUBLE
DN	DOWN
D.S.	DOWNSPOUT
EQ.	EQUAL
EQUIP.	EQUIPMENT
E.T.R.	EXISTING TO REMAIN
EXT.	EXTERIOR
F.D.	FLOOR DRAIN
F.O.E.W.	FACE OF EXISTING WALL
F.O.S.	FACE OF STUD
F.O.S.W.	FACE OF STEM WALL
GWB	GYPSON WALL BOARD
HT.	HEIGHT
INSTAL.	INSTALLATION
MFR.	MANUFACTURER
MTL.	METAL
MTR.	MATERIAL
MIN.	MINIMUM
N.T.S.	NOT TO SCALE
O.C.	ON CENTER
O.T.S.	OPEN TO STRUCTURE
PDC	PEDESTRIAN DECK COATING
P-LAM	PLASTIC LAMINATE
PR	PAIR
PT	PAINT
P.T.	PRESSURE TREATED
PWD	PLYWOOD
R	RANGE
REF.	REFRIGERATOR
REINF.	REINFORCED
RB	RUBBER BASE
SLR	SEALER
SIM.	SIMILAR
SF	SQUARE FEET
SG	SAFETY GLAZING
STL.	STEEL
STRUCT.	STRUCTURAL
TEXT	TEXTURE
TL	TILE
T & G	TONGUE & GROOVE
T.O.W.	TOP OF WALL
TYP.	TYPICAL
U.N.O.	UNLESS NOTED OTHERWISE
WC	WATER CLOSET
WH	WATER HEATER
WD	WOOD
W	WASHER
W	WASH
WR	WATER RESISTANT

TABLE OF CONTENTS

ARCHITECTURAL

AG1.0	COVER SHEET
AG1.1	BUILDING INFORMATION
AG1.2	LAND USE & WSEC INFORMATION
AG1.3	PROJECT INFORMATION
AG1.4	ASSEMBLY TYPES
AG1.5	ACCESSIBLE ENTRANCES
AG1.6	CODE DIAGRAMS
AS1.0	SITE PLAN *REF. ONLY
A1.0	LEVEL 1 - OVERALL PLAN
A1.1	LEVEL 2 - OVERALL PLAN
A1.2	LEVEL 3 - OVERALL PLAN
A1.3	ROOF - OVERALL PLAN
A1.4	LEVEL 1 - ENLARGED LEFT
A1.5	LEVEL 1 - ENLARGED RIGHT
A1.6	LEVEL 2 - ENLARGED LEFT
A1.7	LEVEL 2 - ENLARGED RIGHT
A1.8	LEVEL 3 - ENLARGED LEFT
A1.9	LEVEL 3 - ENLARGED RIGHT
A1.10	ROOF - ENLARGED LEFT
A1.11	ROOF - ENLARGED RIGHT
A1.12	LEVEL 1 - REFLECTED CEILING PLAN
A1.13	LEVEL 2 - REFLECTED CEILING PLAN
A1.14	LEVEL 3 - REFLECTED CEILING PLAN
A2.0	BUILDING ELEVATIONS
A2.1	BUILDING ELEVATIONS
A3.0	BUILDING SECTIONS
A3.1	BUILDING SECTIONS
A3.2	BUILDING SECTIONS
A3.3	BUILDING SECTIONS
A4.0	DOORS & WINDOWS

STRUCTURAL

S1.0	STRUCTURAL NOTES
S1.1	STRUCTURAL NOTES
S3.1	FOUNDATION PLAN
S3.2	LEVEL 2 FLOOR FRAMING
S3.3	LEVEL 3 FLOOR FRAMING
S3.4	ROOF FRAMING
S3.5	LEVEL 1 SHEAR WALLS
S3.6	LEVEL 2 SHEAR WALLS
S3.7	LEVEL 3 SHEAR WALLS
S3.1	SECOND FLOOR SHEAR WALLS
S4.1	FOUNDATION DETAILS
S4.2	FRAMING DETAILS
S4.3	FRAMING DETAILS

MECHANICAL

M0.50	LEGENDS, GENERAL NOTES & INDEX
M0.51	PROJECT NOTES, SCHEDULES, CALCULATIONS & TABLES
M2.51	LEVEL 1 PLAN
M2.52	LEVEL 2 PLAN
M2.53	LEVEL 3 PLAN
M2.54	ROOF PLAN
M5.50	LOAD CALCULATIONS AND MECH FORM

PLUMBING

P0.0	LEGEND, NOTES & DRAWING INDEX
P0.1	SCHEDULES & CALCULATIONS
P2.50	UNDERSLAB PLUMBING PLAN
P2.51	LEVEL 1 WASTE PLAN
P2.52	LEVEL 2 WASTE PLAN
P2.53	LEVEL 3 WASTE PLAN
P3.51	LEVEL 1 SUPPLY PLAN
P3.52	LEVEL 2 SUPPLY PLAN
P3.53	LEVEL 3 SUPPLY PLAN
P4.0A	WASTE DISTRIBUTION DIAGRAM
P4.0B	WASTE DISTRIBUTION DIAGRAM
P4.1	WASTE & VENT RISER DIAGRAMS
P4.2	WASTE & VENT RISER DIAGRAMS
P5.0	SUPPLY DISTRIBUTION DIAGRAMS
P5.1	SUPPLY RISER DIAGRAMS
P6.0	DETAILS
P6.1	DETAILS

PROJECT TEAM

OWNER'S:
ASH DEVELOPMENT, LLC
PUYALLUP, WA
c/o: GREG HELLE
253-318-5711
greg.helle@absherco.com

ARCHITECT :
SYNTHESIS 9, LLC
TACOMA, WA
c/o: BRETT LINDSAY
253-468-4117
blindsay@synthesis9.com

CIVIL ENGINEER:
McINNIS ENGINEERING
TACOMA, WA
c/o: JEFF McINNIS
253-414-1992
jeff@mcinnisengineering.com

STRUCTURAL ENGINEER:
PIERUCCIONI E&C., LLC
TACOMA, WA
c/o: CHON PIERUCCINI
206-949-7866
pieruccioniengineering@gmail.com

LANDSCAPE ARCHITECT:
LYON LANDSCAPE ARCHITECTS
c/ ERIC J. WILLIAMS
TACOMA, WA
253-678-4173
eric@lyonla.com

PLUMBING & MECHANICAL & LIGHTING
ROBISON ENGINEERING INC.
19401 40TH AVE. W. SUITE 302
LYNNWOOD, WA 98036
c/o: JON ROBISON
206-364-3343
jrobison@robisonengineering.com

FIRE SPRINKLERS
SPRINX FIRE PROTECTION, INC.
c/o: JOE FAULKNER
253-853-7780
joe@sprinxfire.com

GENERAL PROJECT NOTES:

- CONTRACTOR SHALL PERFORM ALL WORK WITHIN THIS SCOPE IN ACCORDANCE AND COMPLIANCE WITH ALL RELEVANT, CITY, COUNTY, STATE, AND/OR FEDERAL ORDINANCES, LAWS, REGULATIONS AND CODES. CONTRACTOR SHALL COMPLY WITH ALL REQUIREMENTS ESTABLISHED BY THE 2018 INTERNATIONAL BUILDING CODE (IBC) WITH THE STATE OF WASHINGTON AMENDMENTS.
- THE CONTRACTOR IS RESPONSIBLE FOR FAMILIARIZING HIMSELF WITH THE CONTENT OF THESE DRAWINGS PRIOR TO PROCEEDING WITH THE WORK. DO NOT SCALE THE DRAWINGS.
- IN THE EVENT THE CONTRACTOR FINDS A CONFLICT OR DISCREPANCY WITH THESE DRAWINGS, THE ARCHITECT SHALL BE NOTIFIED IMMEDIATELY IN WRITING. SHOULD THE CONTRACTOR PROCEED WITHOUT NOTIFYING THE ARCHITECT OF SUCH CONFLICT, THE CONTRACTOR SHALL BE PROCEEDING AT HIS OWN RISK & ASSOCIATED LIABILITY.
- THESE DRAWINGS SERVE TO REPRESENT DESIGN INTENT AS DIRECTED BY THE OWNER & COMPLIANT WITH GOVERNING JURISDICTIONAL LAW. IN NO WAY SHALL THESE DRAWINGS SERVE TO DICTATE METHODS OF CONSTRUCTION RELATIVE TO ADHERENCE TO EITHER. IT IS THE CONTRACTOR'S & OWNER'S RESPONSIBILITY TO WORK WITHIN THE PARAMETERS OF THE AGENCY APPROVED DOCUMENTS TO MAINTAIN THE INTEGRITY OF THE DESIGN INTENT AND AGENCY COMPLIANCE. ANY ERRORS, OMISSIONS OR NONCOMPLIANCE WITH GOVERNING CODES SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT IMMEDIATELY.
- CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND SITE CONDITIONS BEFORE STARTING WORK. THE ENGINEER SHALL BE NOTIFIED OF ANY DISCREPANCY. CHANGES, OMISSIONS OR SUBSTITUTIONS ARE NOT PERMITTED WITHOUT WRITTEN APPROVAL OF THE ENGINEER.
- THE DESIGN, ADEQUACY AND SAFETY OF ERECTION BRACING, SHORING, TEMPORARY SUPPORTS, ETC., IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR, AND HAS NOT BEEN CONSIDERED BY THE ENGINEER. THE CONTRACTOR IS RESPONSIBLE FOR THE STABILITY OF THE STRUCTURE PRIOR TO THE COMPLETION OF ALL SHEAR WALLS, ROOF AND FLOOR DIAPHRAGMS AND FINISHED MATERIALS. THE CONTRACTOR SHALL PROVIDE THE NECESSARY BRACING TO PROVIDE STABILITY PRIOR TO THE APPLICATION OF THE ABOVE MENTIONED COMPONENTS.
- CONTRACTOR SHALL MAINTAIN THE JOBSITE IN A CLEAN AND PROFESSIONAL CONDITION. ANY DEBRIS GENERATED DURING CONSTRUCTION SHALL BE REMOVED FROM THE LOCAL JOBSITE CONTINUALLY. LOCAL JOBSITES SHALL BE LEFT IN A CLEAN AND NEAT CONDITION AT THE END OF EACH WORKDAY. DEBRIS REMOVAL FROM THE JOBSITE SHALL BE ONGOING. CONTRACTOR SHALL DISPOSE ALL MATERIALS AND DEBRIS IN A LEGAL MANNER. ALL PEDESTRIAN AND VEHICULAR ACCESS-WAYS SHALL BE MAINTAINED IN A CLEAN CONDITION THROUGHOUT THE PROJECT.
- SPECIAL INSPECTION SHALL BE PROVIDED BY AND INDEPENDENT TESTING LABORATORY PER THE REQUIREMENTS OF IBC CHAPTER 17 AND THE LOCAL BUILDING OFFICIAL OR APPLICABLE JURISDICTION AND CONTRACT DOCUMENTS. THE SPECIAL INSPECTOR SHALL SUBMIT INSPECTION REPORTS AND A FINAL SIGNED REPORT TO THE BUILDING OFFICIAL FOR THE ITEMS LISTED IN THE QUALITY ASSURANCE/SPECIAL INSPECTION SECTION:
- THE CONTRACTOR SHALL VERIFY THE DIMENSIONS REQUIRED FOR ALL EQUIPMENT, APPLIANCES, FIXTURES, CABINETS, DUCTWORK AND OPENINGS BEFORE FRAMING BEGINS. THE CONTRACTOR SHALL COORDINATE WITH THE SUBCONTRACTORS OF ALL TRADES TO VERIFY THE SIZES AND LOCATIONS OF OPENINGS THROUGH THE FLOORS, WALLS, CEILINGS AND ROOFS FOR DUCTS, PIPES, CONDUITS AND EQUIPMENT. THE CONTRACTOR SHALL COORDINATE THE LOCATION AND INSTALLATION OF WOOD BACKING, BLOCKING, FURRING AND STRIPPING AS REQUIRED FOR THE INSTALLATION AND ATTACHMENT OF WORK OF ALL TRADES.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE SYSTEMS, INCLUDING, BUT NOT LIMITED TO, MECHANICAL, PLUMBING, ELECTRICAL WORK. WORK SHOWN IN THE DRAWINGS IS INTENDED TO ILLUSTRATE THE GENERAL DESIGN INTENT, SCOPE AND LOCATION OF WORK. ALL WORK NOT SPECIFICALLY DRAWN, BUT REQUIRED FOR A COMPLETE, LEGAL AND FUNCTIONING SYSTEM, SHALL BE PROVIDED AS PART OF THE WORK.

PROJECT SCOPE

THE OVERALL ARCHITECTURAL SCOPE OF THIS PROJECT IS CONSTRUCT FIVE APARTMENT BUILDINGS, FIVE CARPORTS, A COVERED MAILBOX/BUS STOP STRUCTURE, FIVE CARPORTS AND RELATED SITE DEVELOPMENT.

REFER TO THE FOLLOWING APPLICATION NUMBERS:
SITE DEVELOPMENT: **PRCCP20230970**

BUILDING ENCLOSURE NOTE:

THE BUILDING ENCLOSURE DOCUMENTATION WITHIN THIS DRAWING SET SATISFIES THE REQUIREMENTS OF RCW 64.55.005 THROUGH 64.55.090. NOTE THAT A THIRD PARTY QUALIFIED INSPECTOR OR THE ARCHITECT WHO APPROVED THE BUILDING ENCLOSURE DESIGN SHALL INSPECT THE BUILDING ENCLOSURE DURING THE COURSE OF CONSTRUCTION FOR COMPLIANCE WITH THE BUILDING ENCLOSURE DESIGN DOCUMENTS. NOTE THAT UPON COMPLETION OF THE INSPECTIONS, THE QUALIFIED INSPECTOR SHALL SUBMIT A SIGNED LETTER OF CERTIFICATION TO THE CITY OF TACOMA REGARDING THE INSPECTION AND SUBSTANTIAL COMPLIANCE OF THE BUILDING CONSTRUCTION WITH THE BUILDING ENCLOSURE DESIGN DOCUMENTS. NOTE THAT IT IS THE CONTRACTORS RESPONSIBILITY TO ENSURE THAT THE INSPECTOR IS NOTIFIED FOR REGULAR INSPECTIONS OF THE BUILDING ENCLOSURE INSTALLATION.

SYMBOL LEGEND

DETAIL SYMBOL
① — DETAIL NO. OR LETTER
A2.0 — SHEET

SECTION SYMBOL
① — DETAIL NO. OR LETTER
A2.0 — SHEET

INTERIOR ELEVATION SYMBOL
2 — SPECIFIC DETAIL NO.
A4.0 — DRAWING NUMBER SHEET

DOOR I.D. SYMBOL
100A — DOOR NUMBER
REFER TO SHEET A4.0.


ROOM I.D. SYMBOL
ROOM — ROOM NAME
100 — ROOM NUMBER

WALL TYPE SYMBOL
1A — WALL TYPE NO.
REFER TO SHEET A2.0

FLOOR - CEILING ASSEMBLY TYPE SYMBOL
Z# — ASSEMBLY TYPE NO.
REFER TO SHEET AG.03


EXTERIOR WINDOW TYPE SYMBOL
— WINDOW TYPE LETTER

BUILDING REFERENCE NOTE SYMBOL
— WINDOW TYPE LETTER

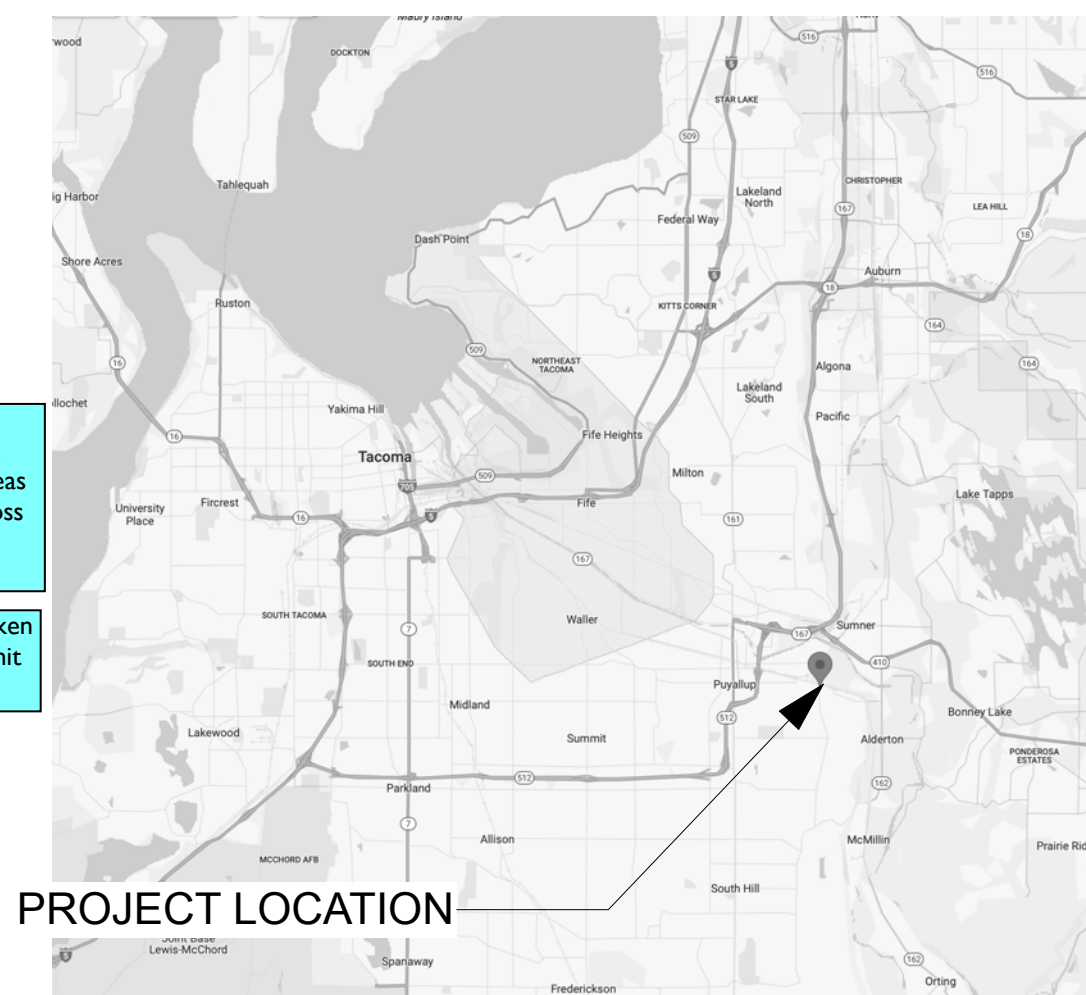

PROJECT LOCATION

VICINITY MAP (NOT TO SCALE)



City of Puyallup Development Engineering APPROVED

See permit for additional requirements.

Linda Lin
940-7024
11:11-45 AM



Call Before You Dig. It's the law. Locate all utilities prior to starting work. Dial 811 or call 1-800-424-5555.

The applicant shall request a sediment control and erosion inspection with a City Engineering Inspector through the CityView portal at least 48 hours in advance of job start. Refer to the Stormwater Fact Sheet and City Standards 02.03.02 & 05.02.01

Sediment control and erosion procedures shall be practiced eliminating and preventing off site damage. Stormwater runoff originating upgrade of exposed areas shall be controlled to reduce erosion and sediment loss during the period of exposure. See civil permit PRCCP20230970 for specifications

Roof downspout control is required. Steps shall be taken to prevent drainage onto adjacent lots. See civil permit PRCCP20230970 for specifications



SYNTHESIS 9, LLC
6214 D ST
TACOMA, WA 98403

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE ORIGINAL DESIGN INCORPORATED HEREIN ARE THE PROPERTY OF SYNTHESIS 9, LLC AND ARE NOT TO BE USED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN AUTHORIZATION OF SYNTHESIS 9, LLC.



REGISTERED ARCHITECT
Brett Lindsay
Brett Lindsay
STATE OF WASHINGTON

REGISTERED CIVIL ENGINEER
JEFF McINNIS
JEFF McINNIS
STATE OF WASHINGTON

REGISTERED LANDSCAPE ARCHITECT
ERIC J. WILLIAMS
ERIC J. WILLIAMS
STATE OF WASHINGTON

REGISTERED PLUMBING & MECHANICAL & LIGHTING ENGINEER
JON ROBISON
JON ROBISON
STATE OF WASHINGTON

REGISTERED FIRE PROTECTION ENGINEER
JOE FAULKNER
JOE FAULKNER
STATE OF WASHINGTON

EAST TOWN CROSSING
BUILDING 'F'
PIONEER & SHAW PUYALLUP WA

REVISIONS


NO.	DESCRIPTION	DATE

REVISIONS


DRAWN BY: BL / CM
CHECKED BY: BL
DATE: 24.03.11
TITLE: COVER SHEET
PROJECT #: 2016
SHEET:

AG1.0


AGENCY REVIEW | 24.03.11

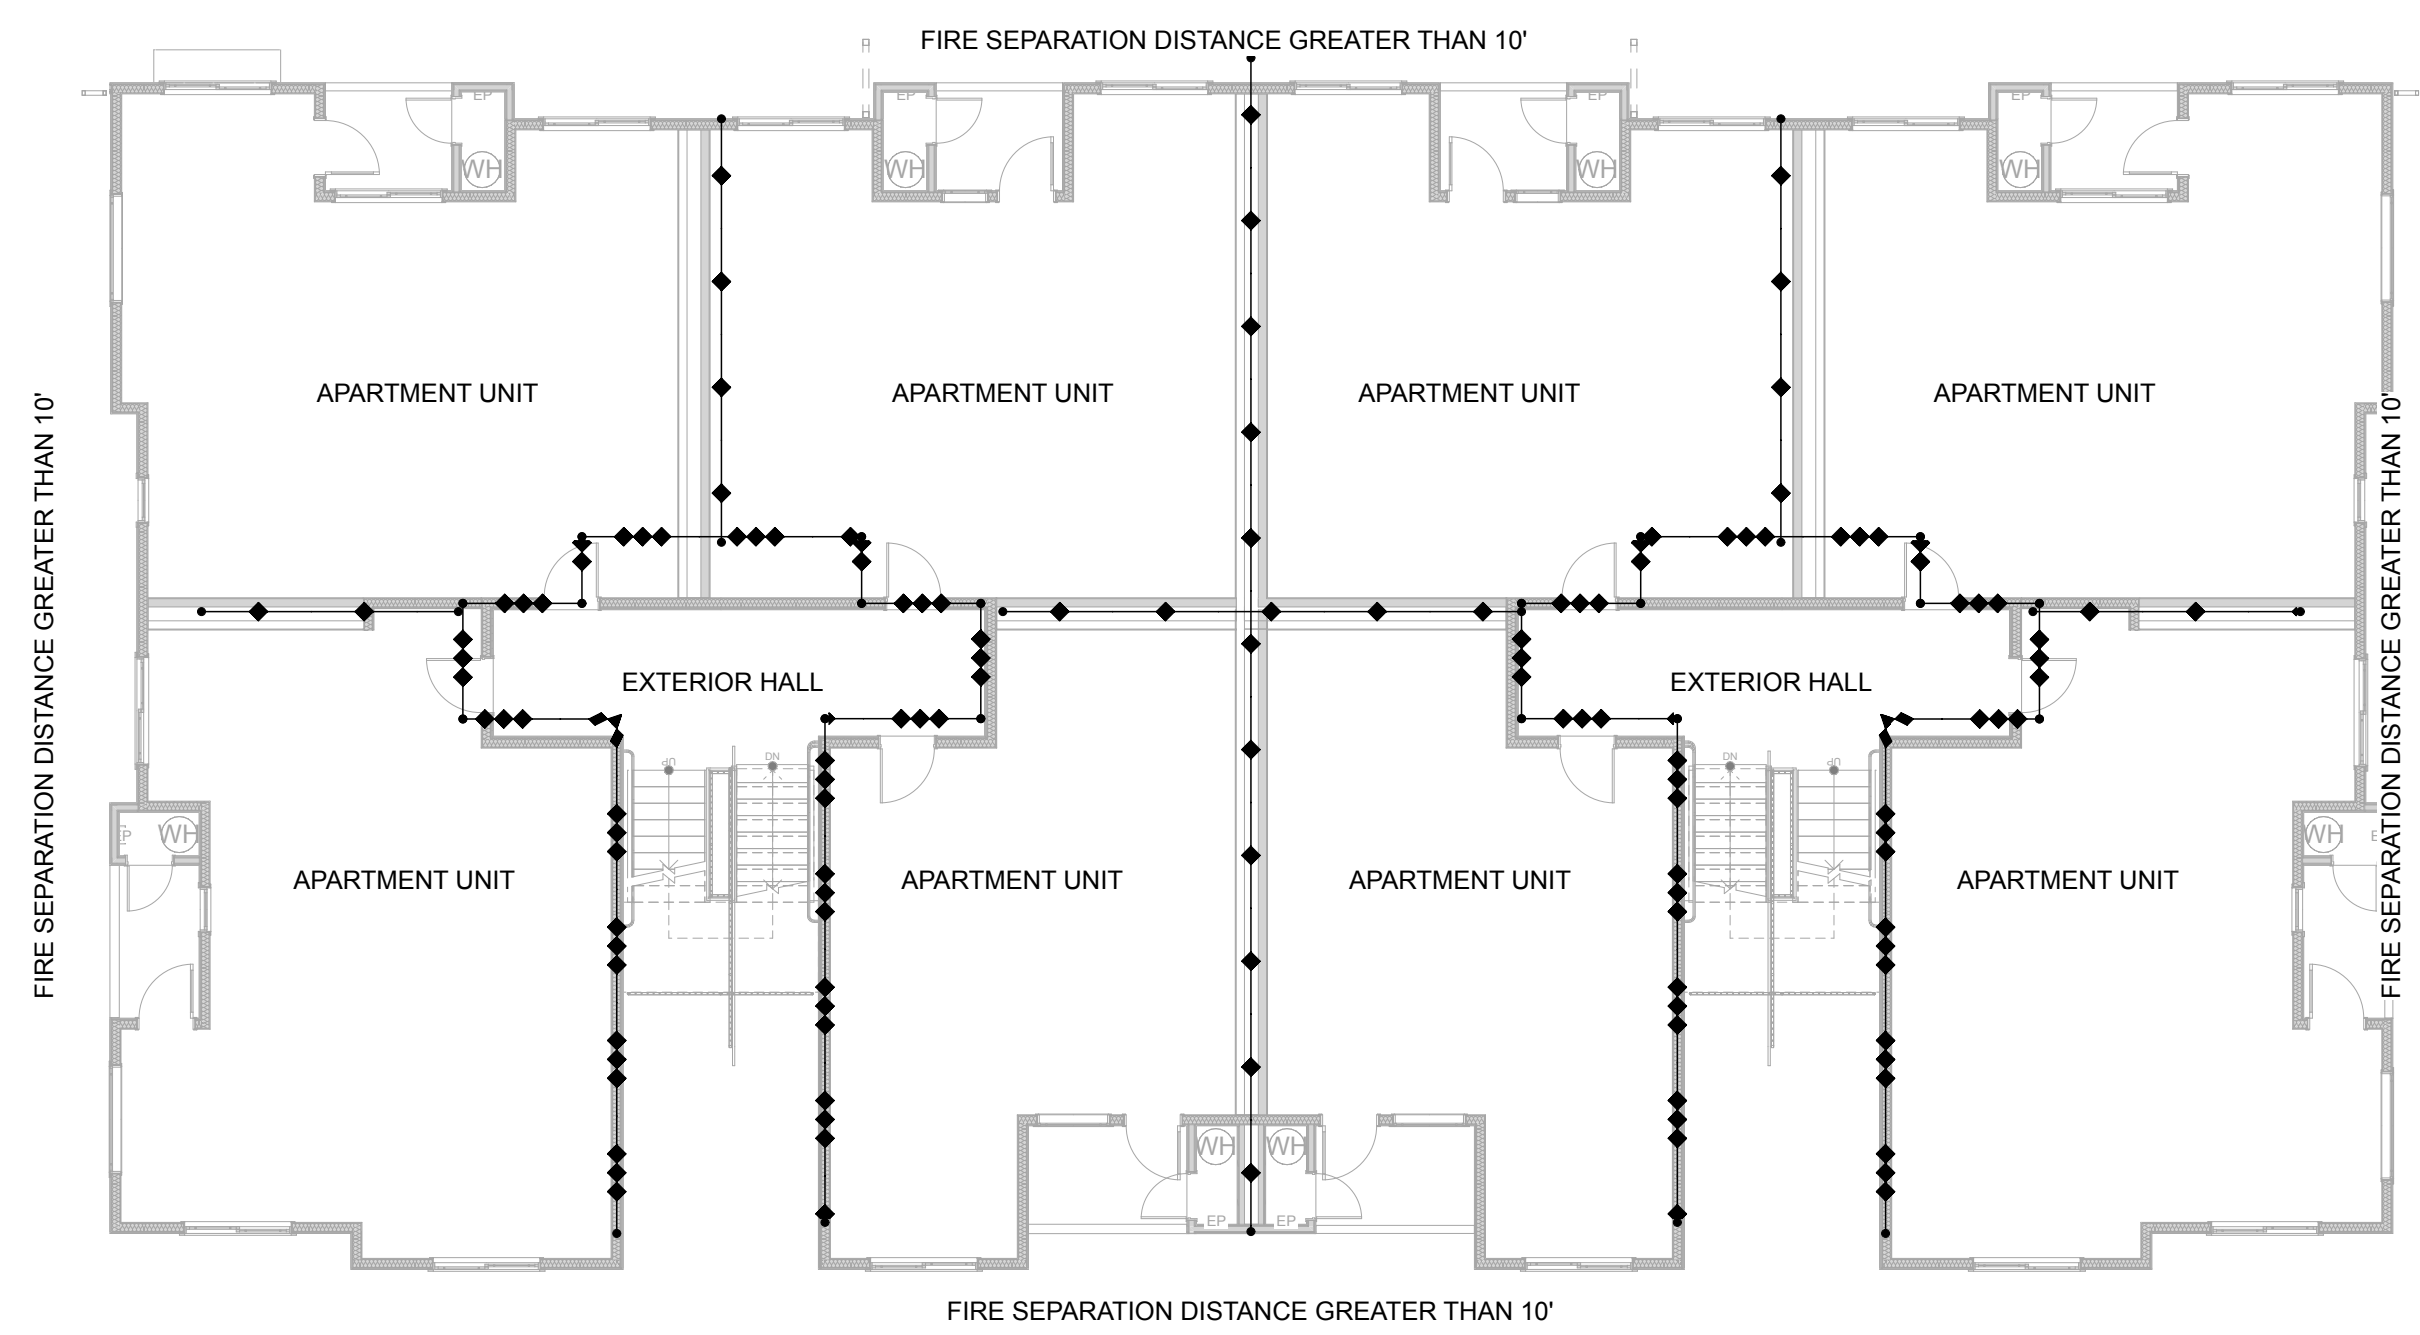

1 RATED WALLS LEVEL 2 & 3
SCALE: 3/32" = 1'-0"

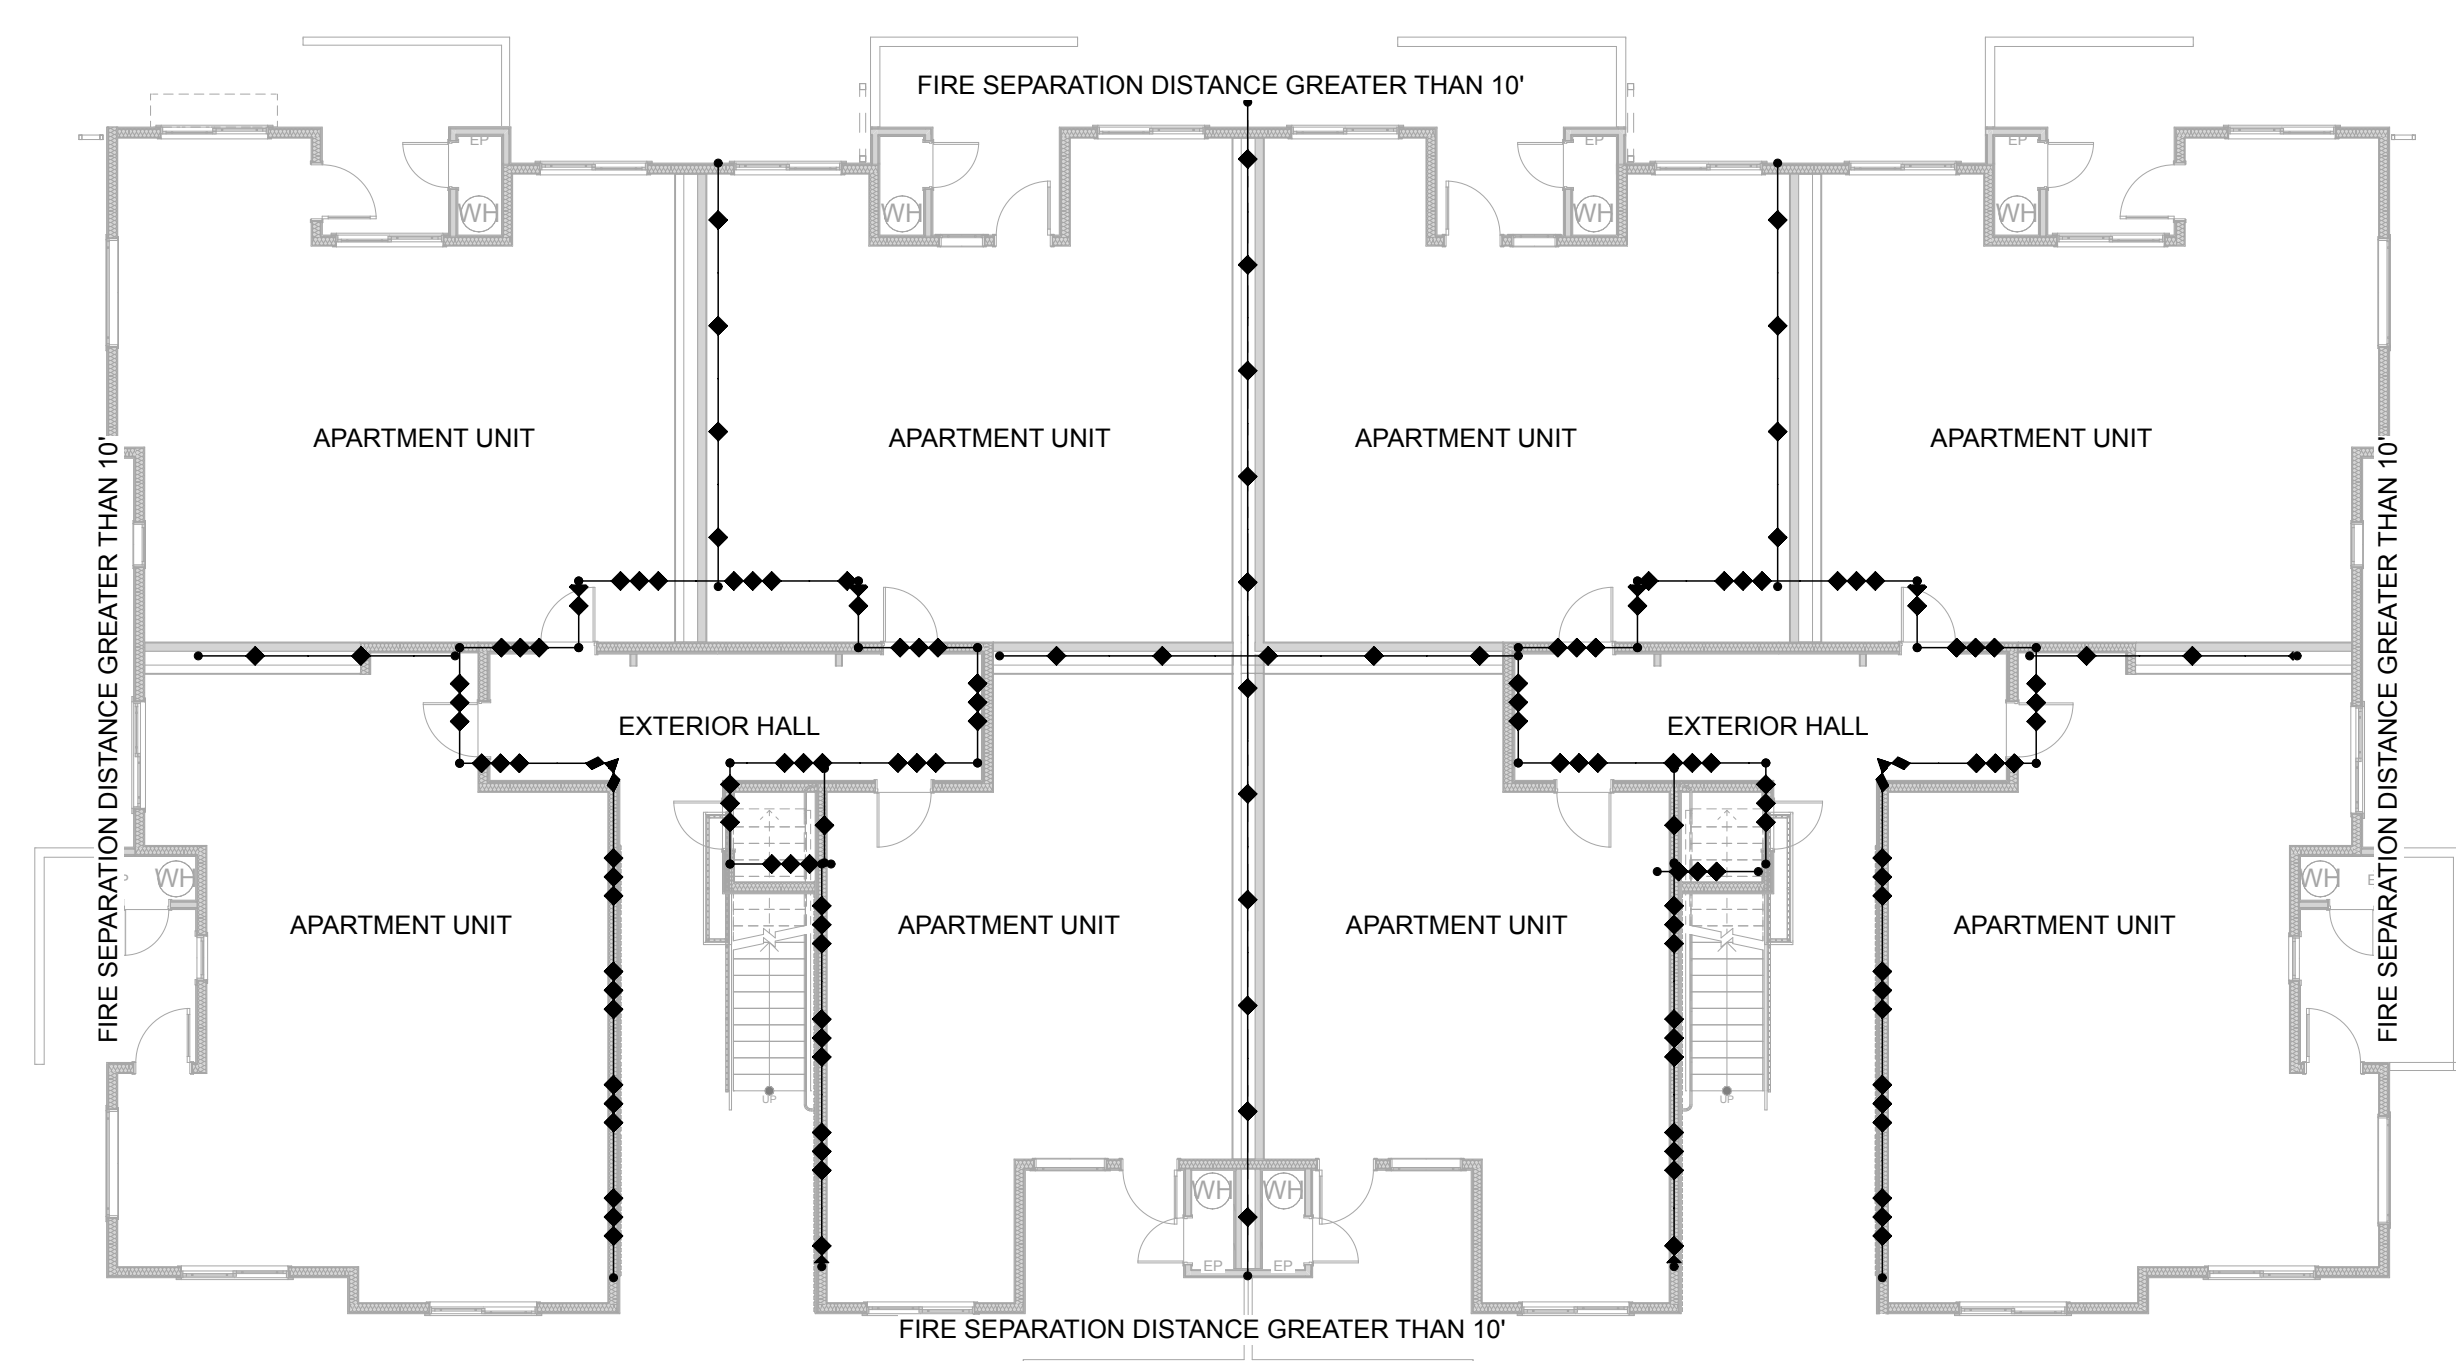


2 RATED WALLS LEVEL 1
SCALE: 3/32" = 1'-0"

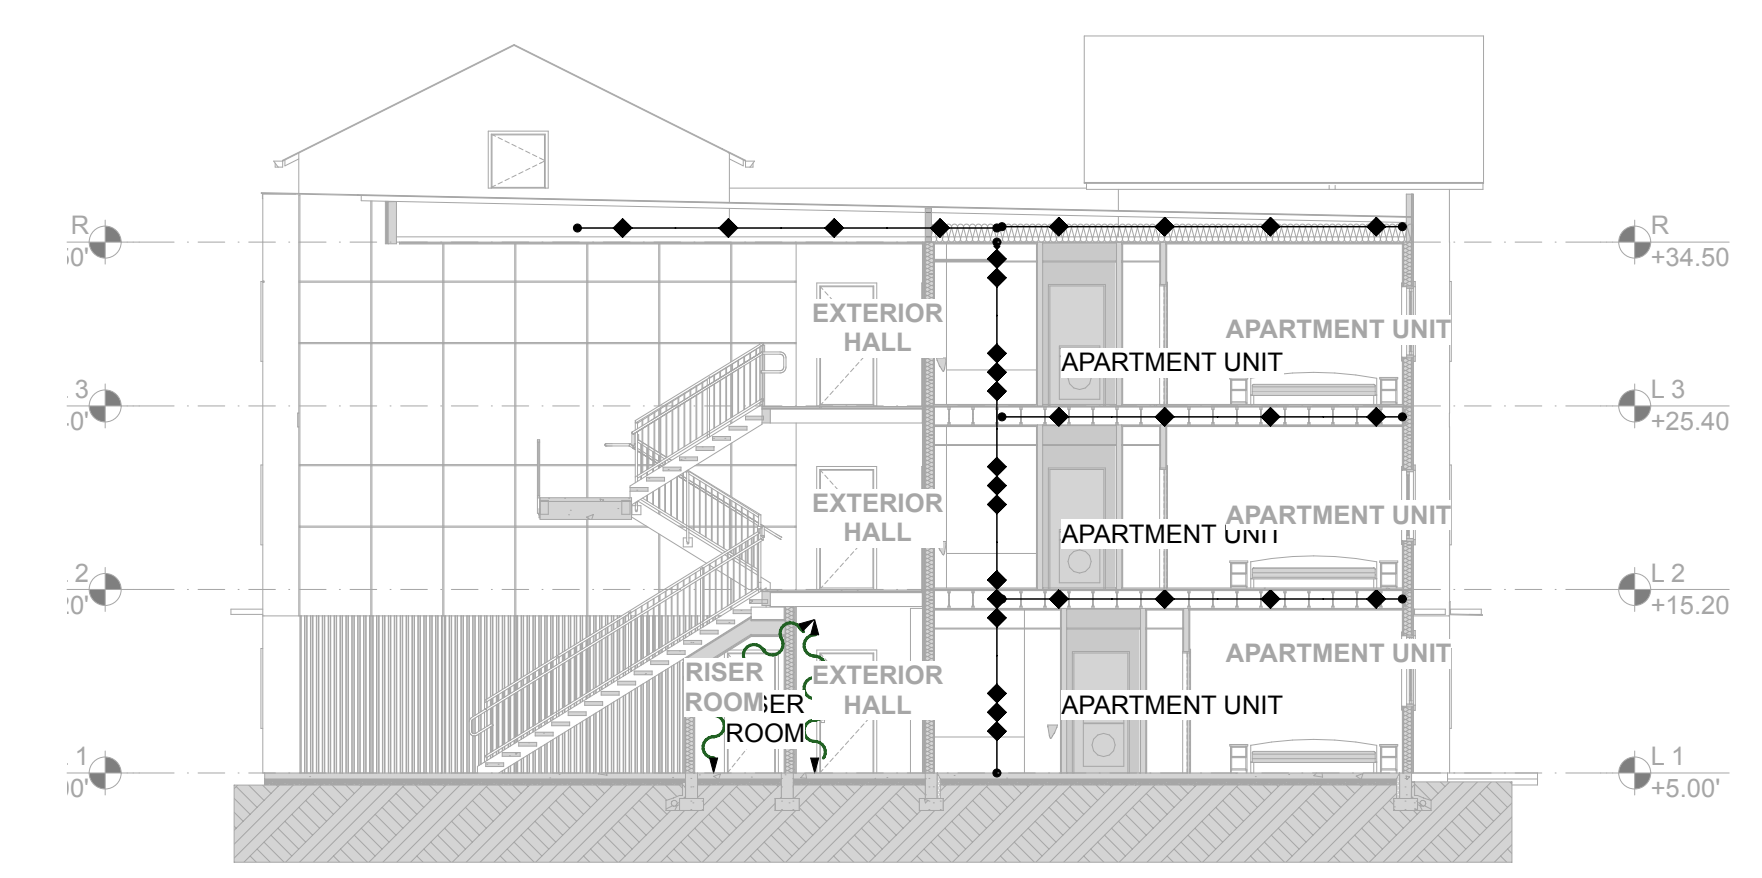

3 RATED ASSEMBLIES SECTION
SCALE: 3/32" = 1'-0"

- RATED ASSEMBLY DIAGRAM LEGEND**
- ◆ ◆ ◆ ◆ 1-HR RATED PARTITION WALL ASSEMBLY AND/OR 1-HR RATED FLOOR/CEILING ASSEMBLY OR 1-HR CEILING/ROOF ASSEMBLY
 - ◆ ◆ ◆ ◆ EXTERIOR WALL
1-HR RATED WALL ASSEMBLY WITH OPENINGS LIMITED TO 10% WHEN DISTANCE TO PROPERTY LINE IS BETWEEN 5-FT TO 10-FT, NO OPENINGS WHEN DISTANCE LESS THAN 5-FT. WALL SHALL BE RATED FOR EXPOSURE TO FIRE FROM BOTH SIDES
 - ◆ ◆ ◆ ◆ EXIT PASSAGEWAY
1-HR RATED, FIRE BARRIER, CONTINUOUS TO FLOOR DECKS WITH 1-HR RATED OPENINGS & 1-HR RATED CEILING/ROOF ASSEMBLY

REVISIONS	
REVISIONS	
DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	24.03.11
TITLE:	CODE DIAGRAMS
PROJECT #:	2016
SHEET:	

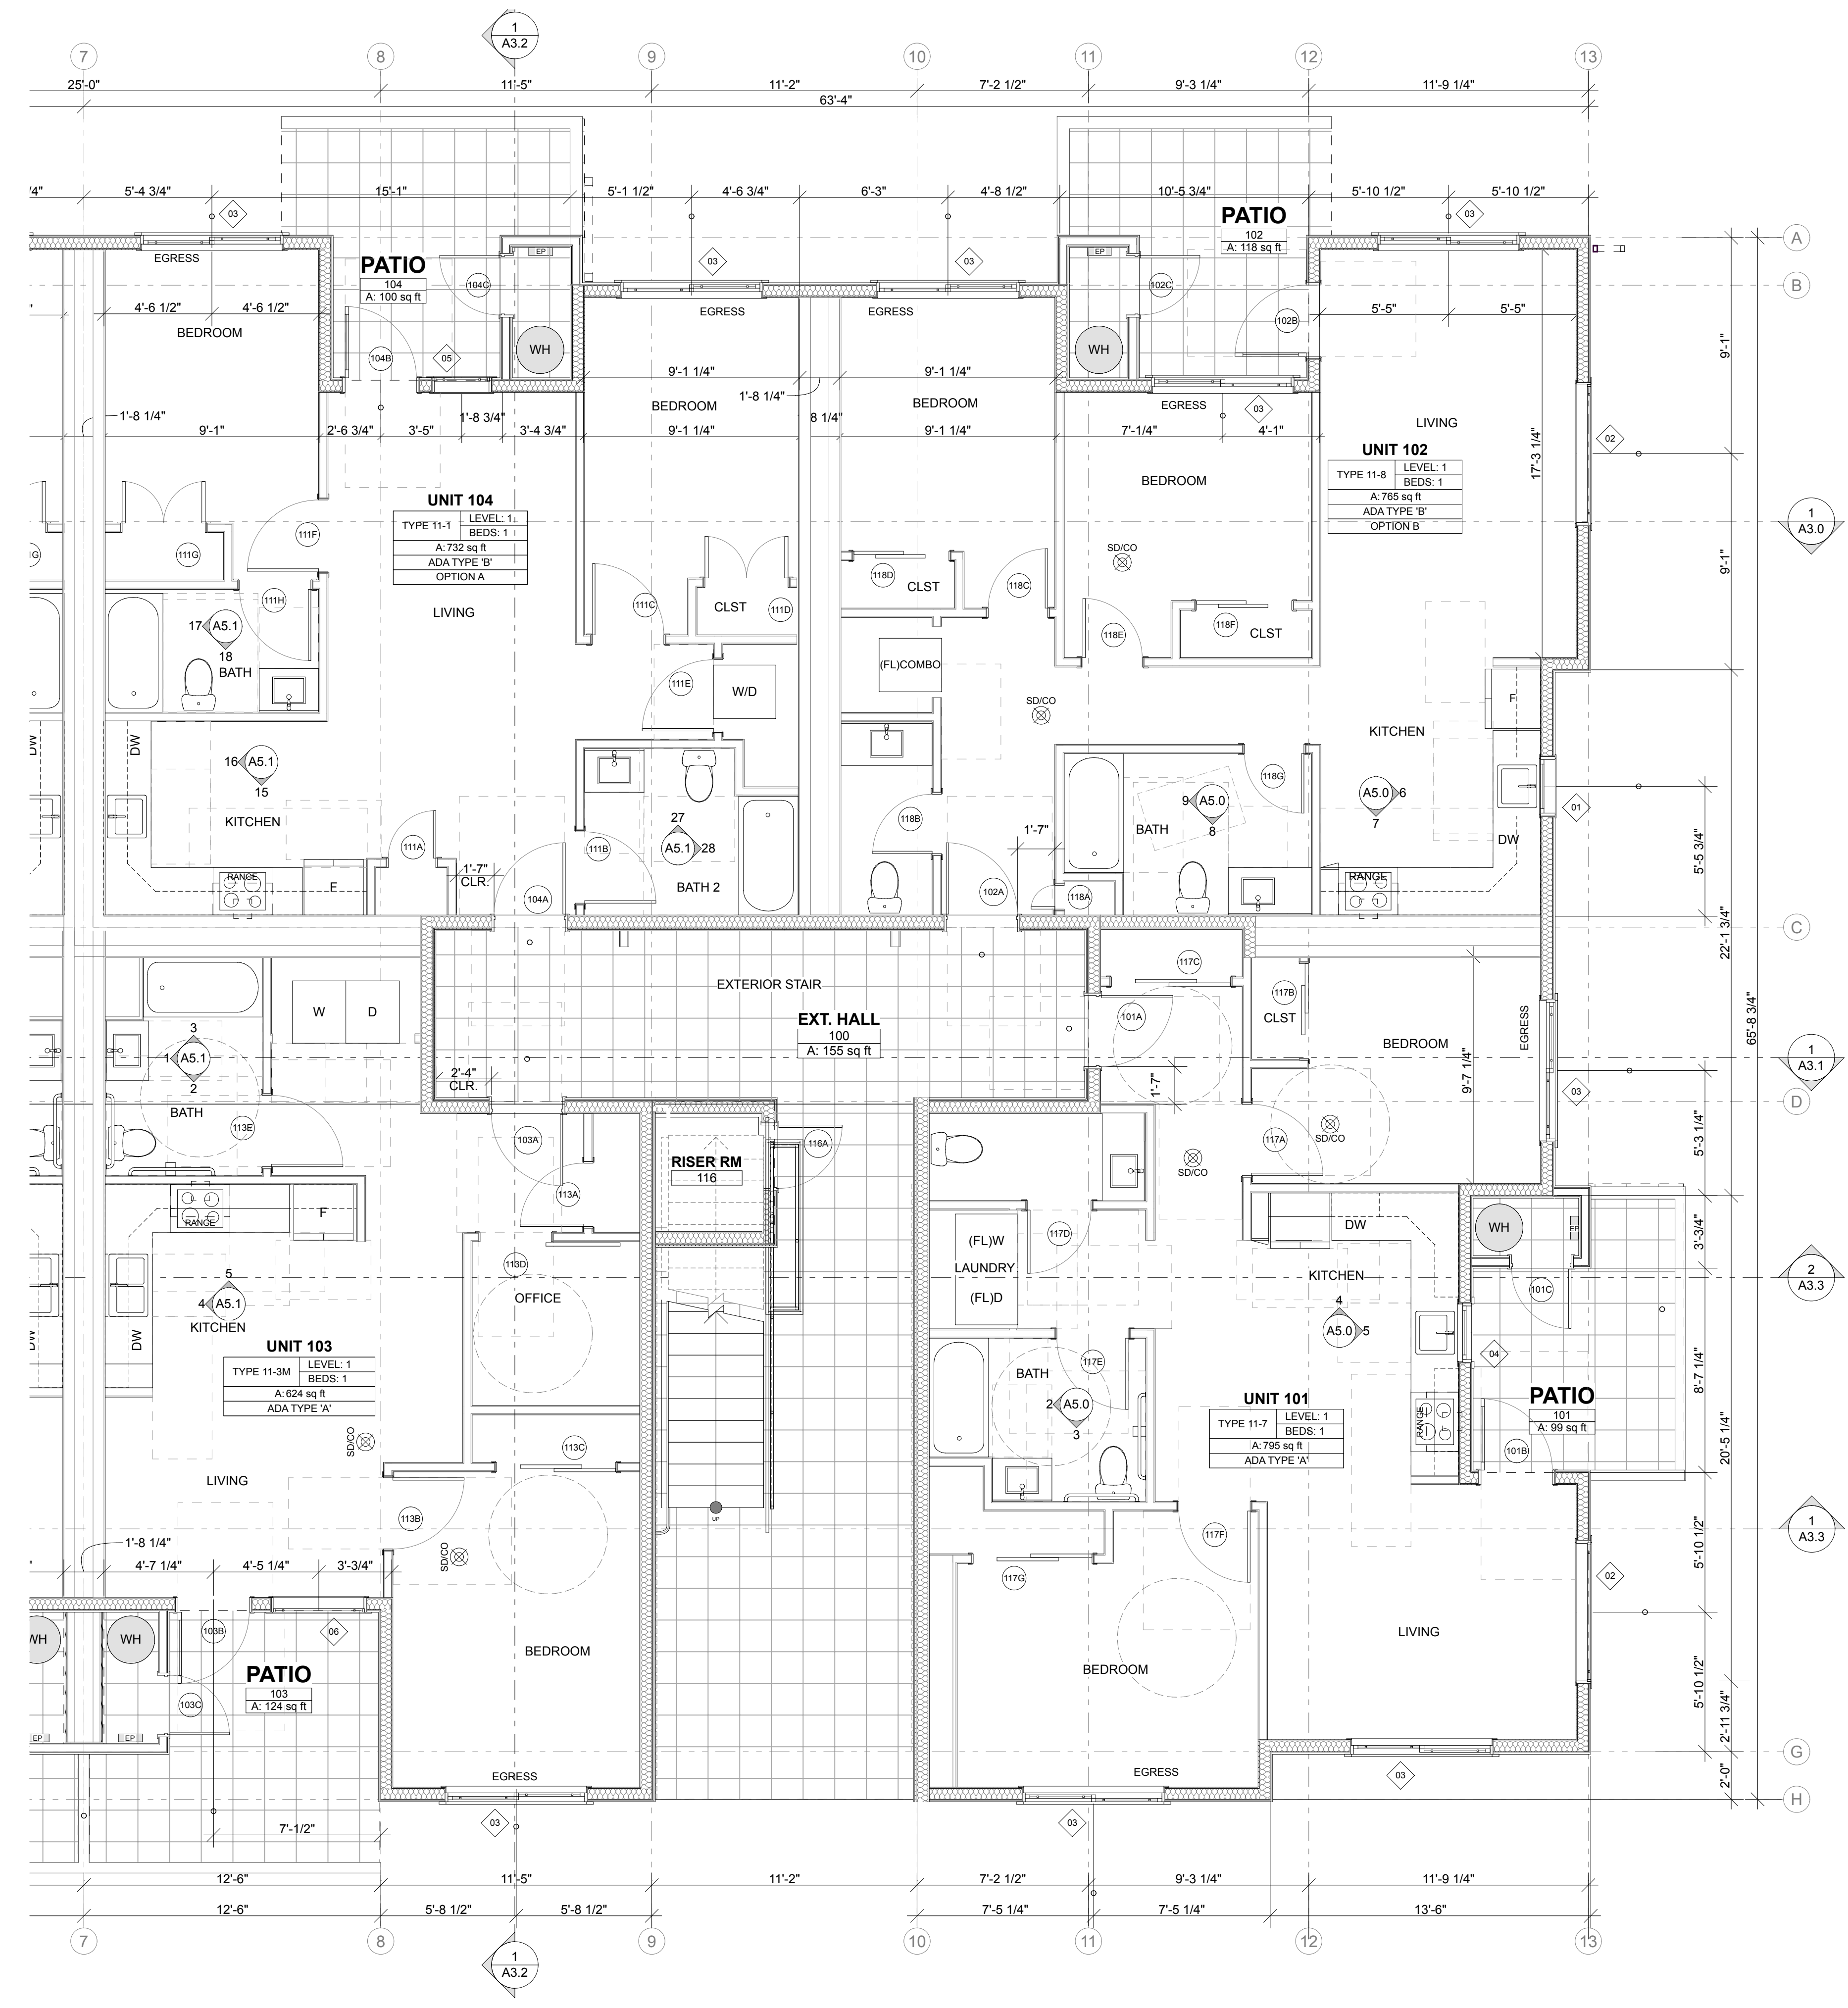

1 LEVEL 1 - ENLARGED
SCALE: 1/4" = 1'-0"

EAST TOWN CROSSING
BUILDING 'F'
PIONEER & SHAW PUYALLUP WA


REVISIONS

NO.	DATE	DESCRIPTION


REVISIONS

DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	24.03.11
TITLE:	LEVEL 1 - ENLARGED RIGHT
PROJECT #:	2016
SHEET:	


AGENCY REVIEW | 24.03.11

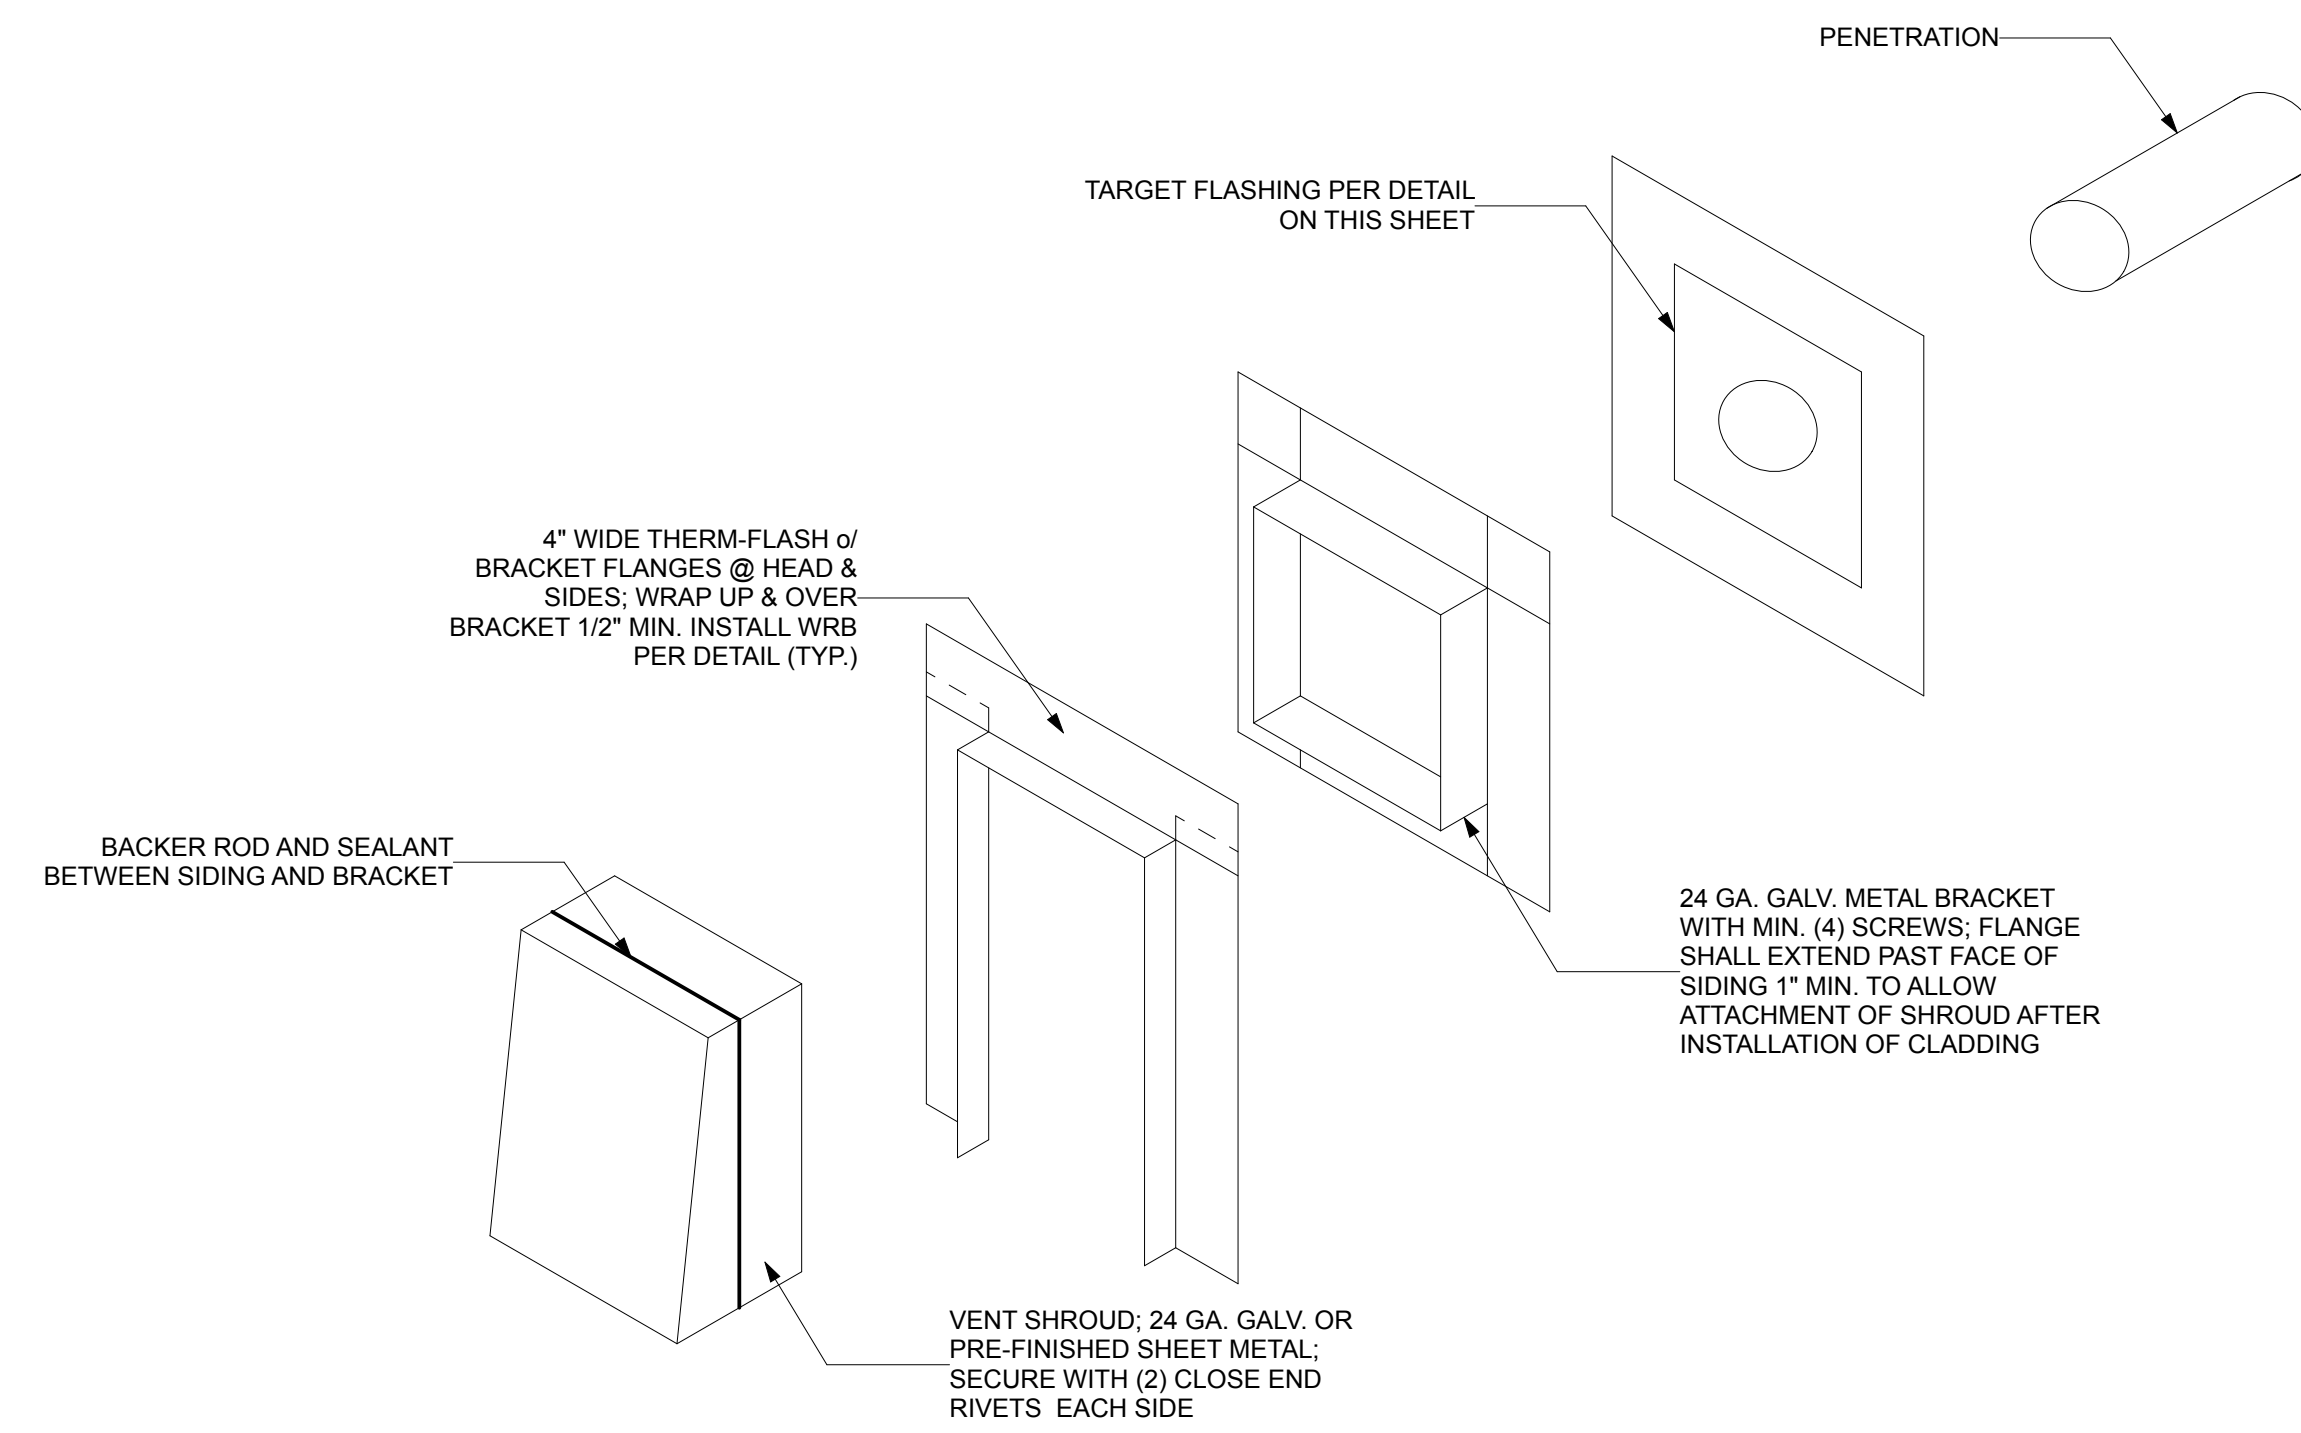

3 VENT PENETRATIONS
SCALE: 3/8" = 1'-0"

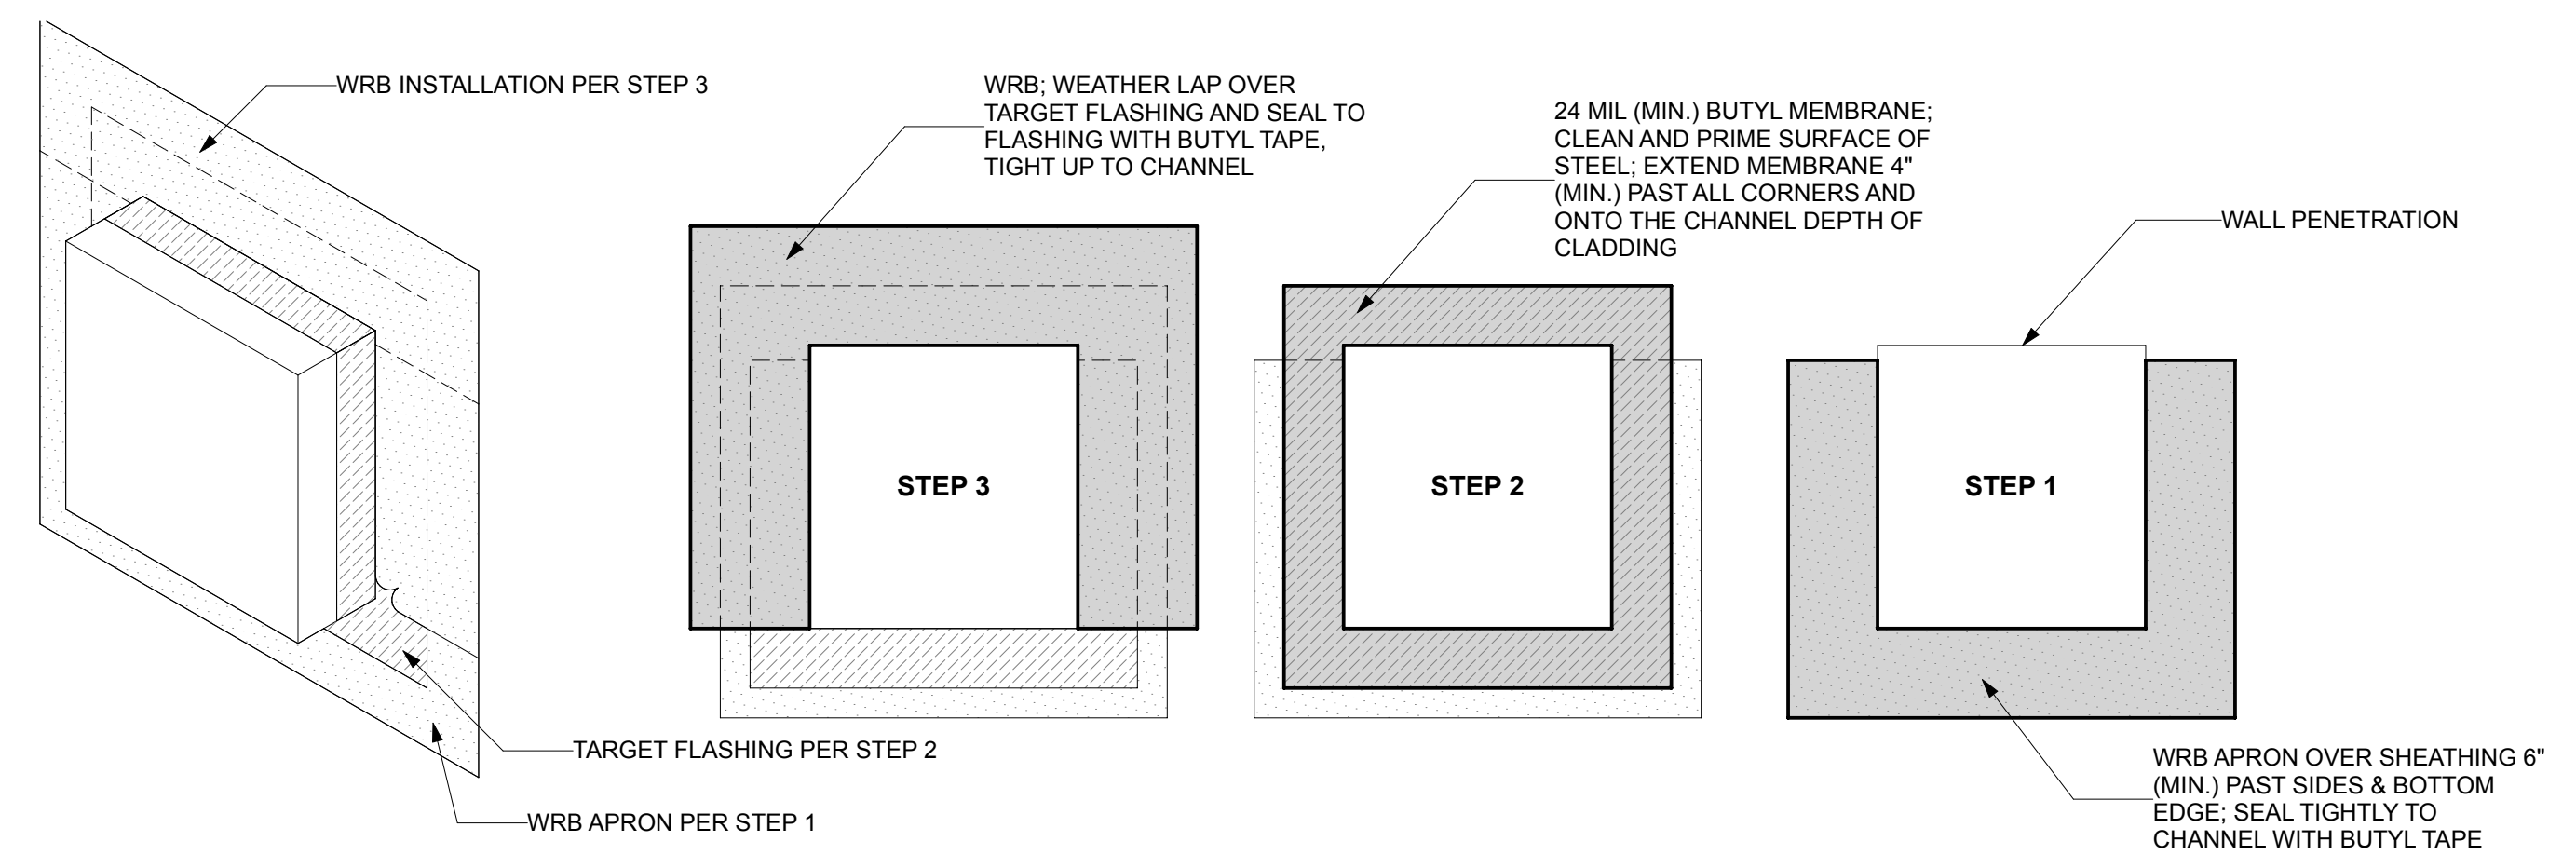


1 TARGET FLASHING INSTALLATION FOR PENETRATIONS > 6"
SCALE: 1" = 1'-0"

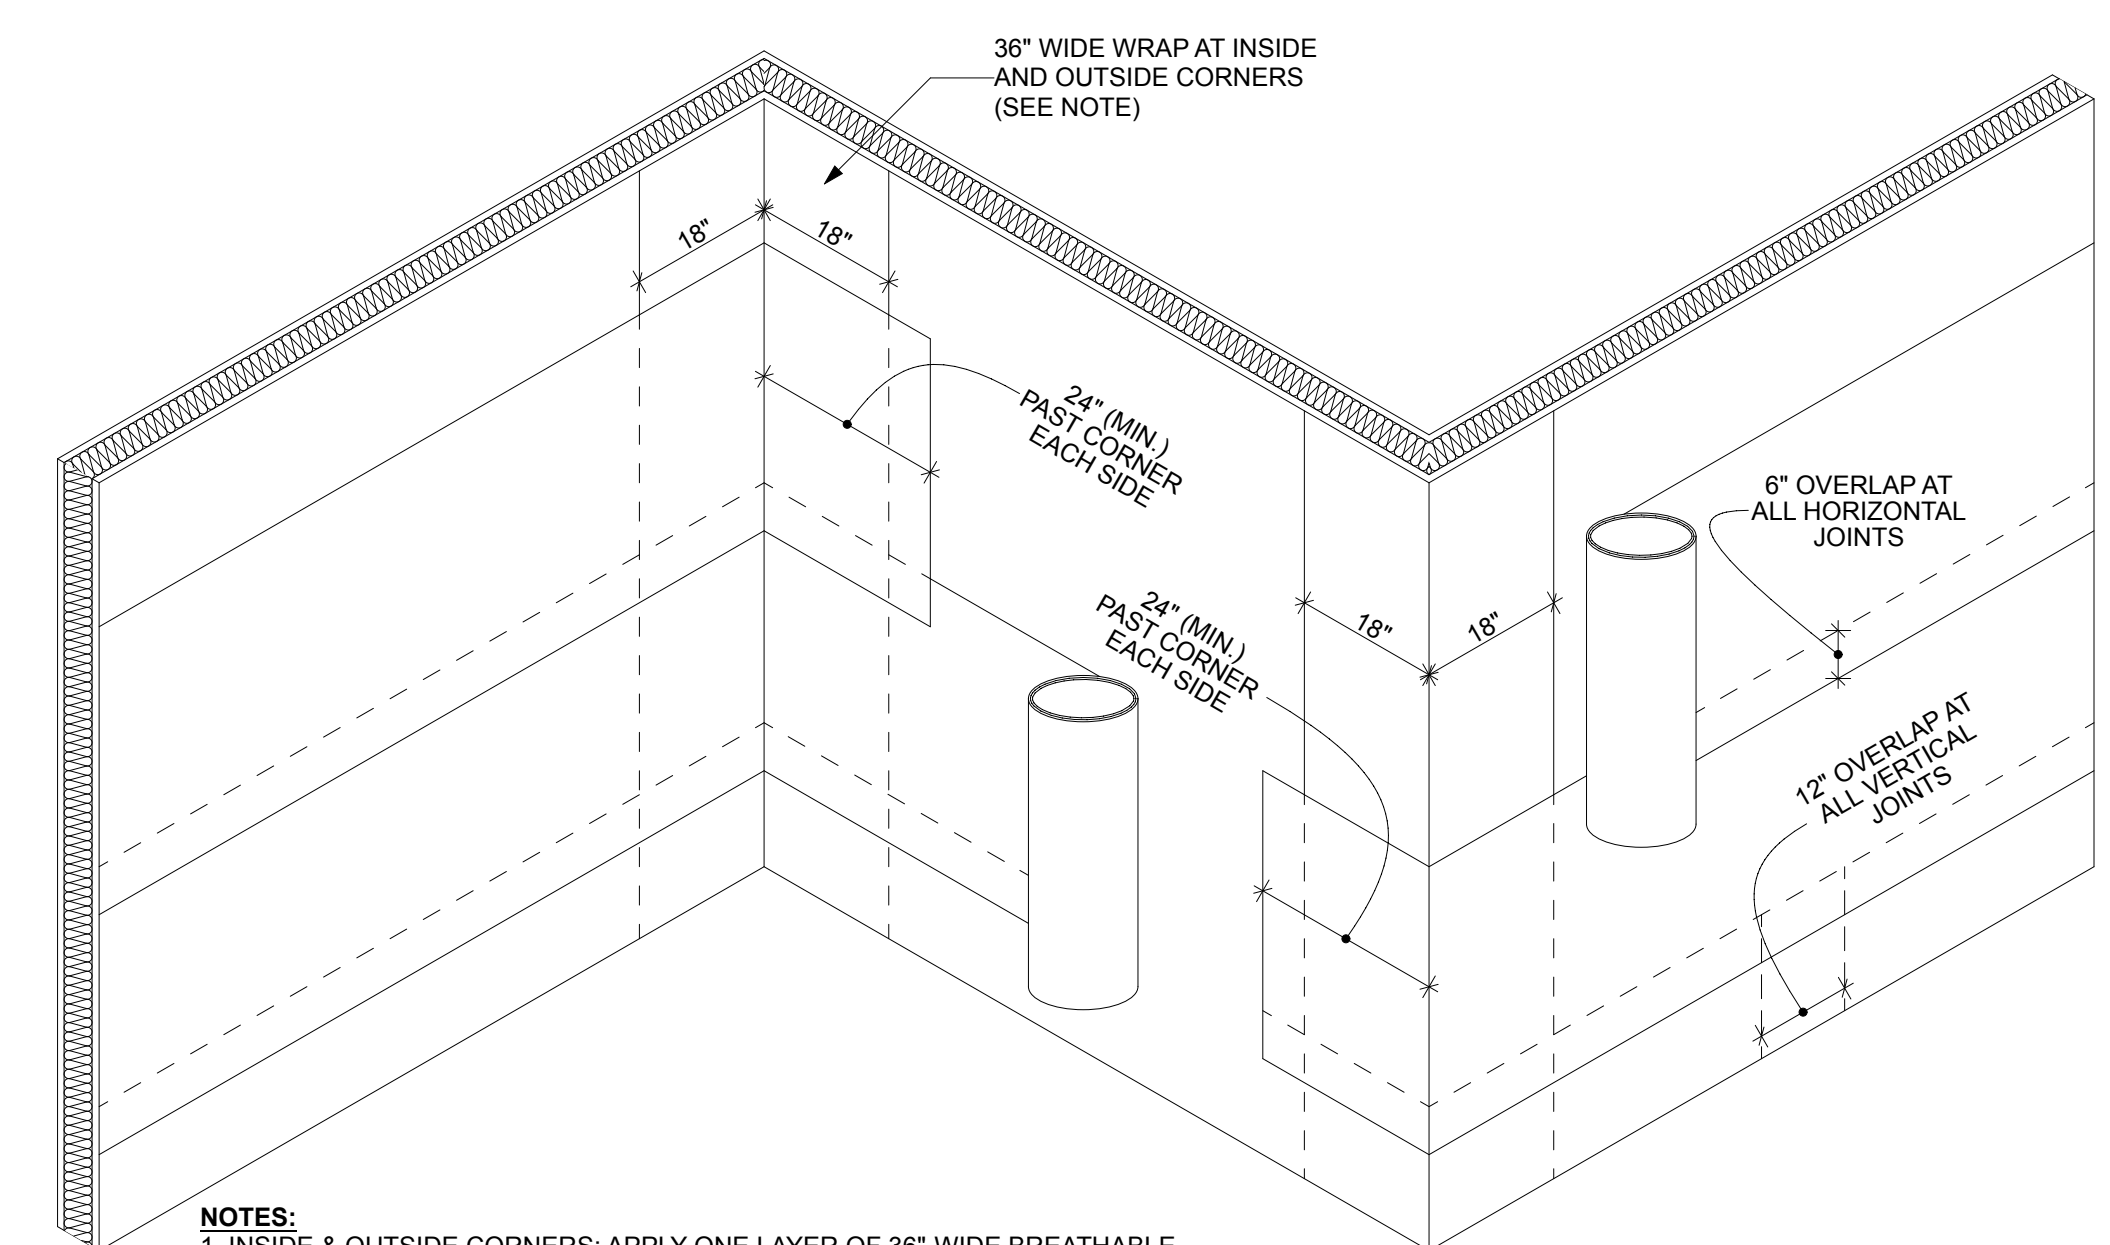


2 WRB INSTALLATION
SCALE: 1/2" = 1'-0"


NOTES:
1. INSIDE & OUTSIDE CORNERS; APPLY ONE LAYER OF 36"-WIDE BREATHABLE MEMBRANE FROM THE SAME MANUFACTURER AS THE WRB PER NOTE 15 PRIOR TO INSTALLATION OF FIELD WRB.
2. INSTALL WEATHER RESISTIVE BARRIER PER NOTE 15 IN WEATHERBOARD FASHION STARTING FROM THE BOTTOM OF THE WALL. ENSURE THAT THE EDGES OF THE LAYERS OF WRB ARE STAGGERED AT LEAST 6".
3. WHERE CONCRETE SURFACES OCCUR, INSTALL VAPROSHIELD S.A.M. THROUGHOUT.

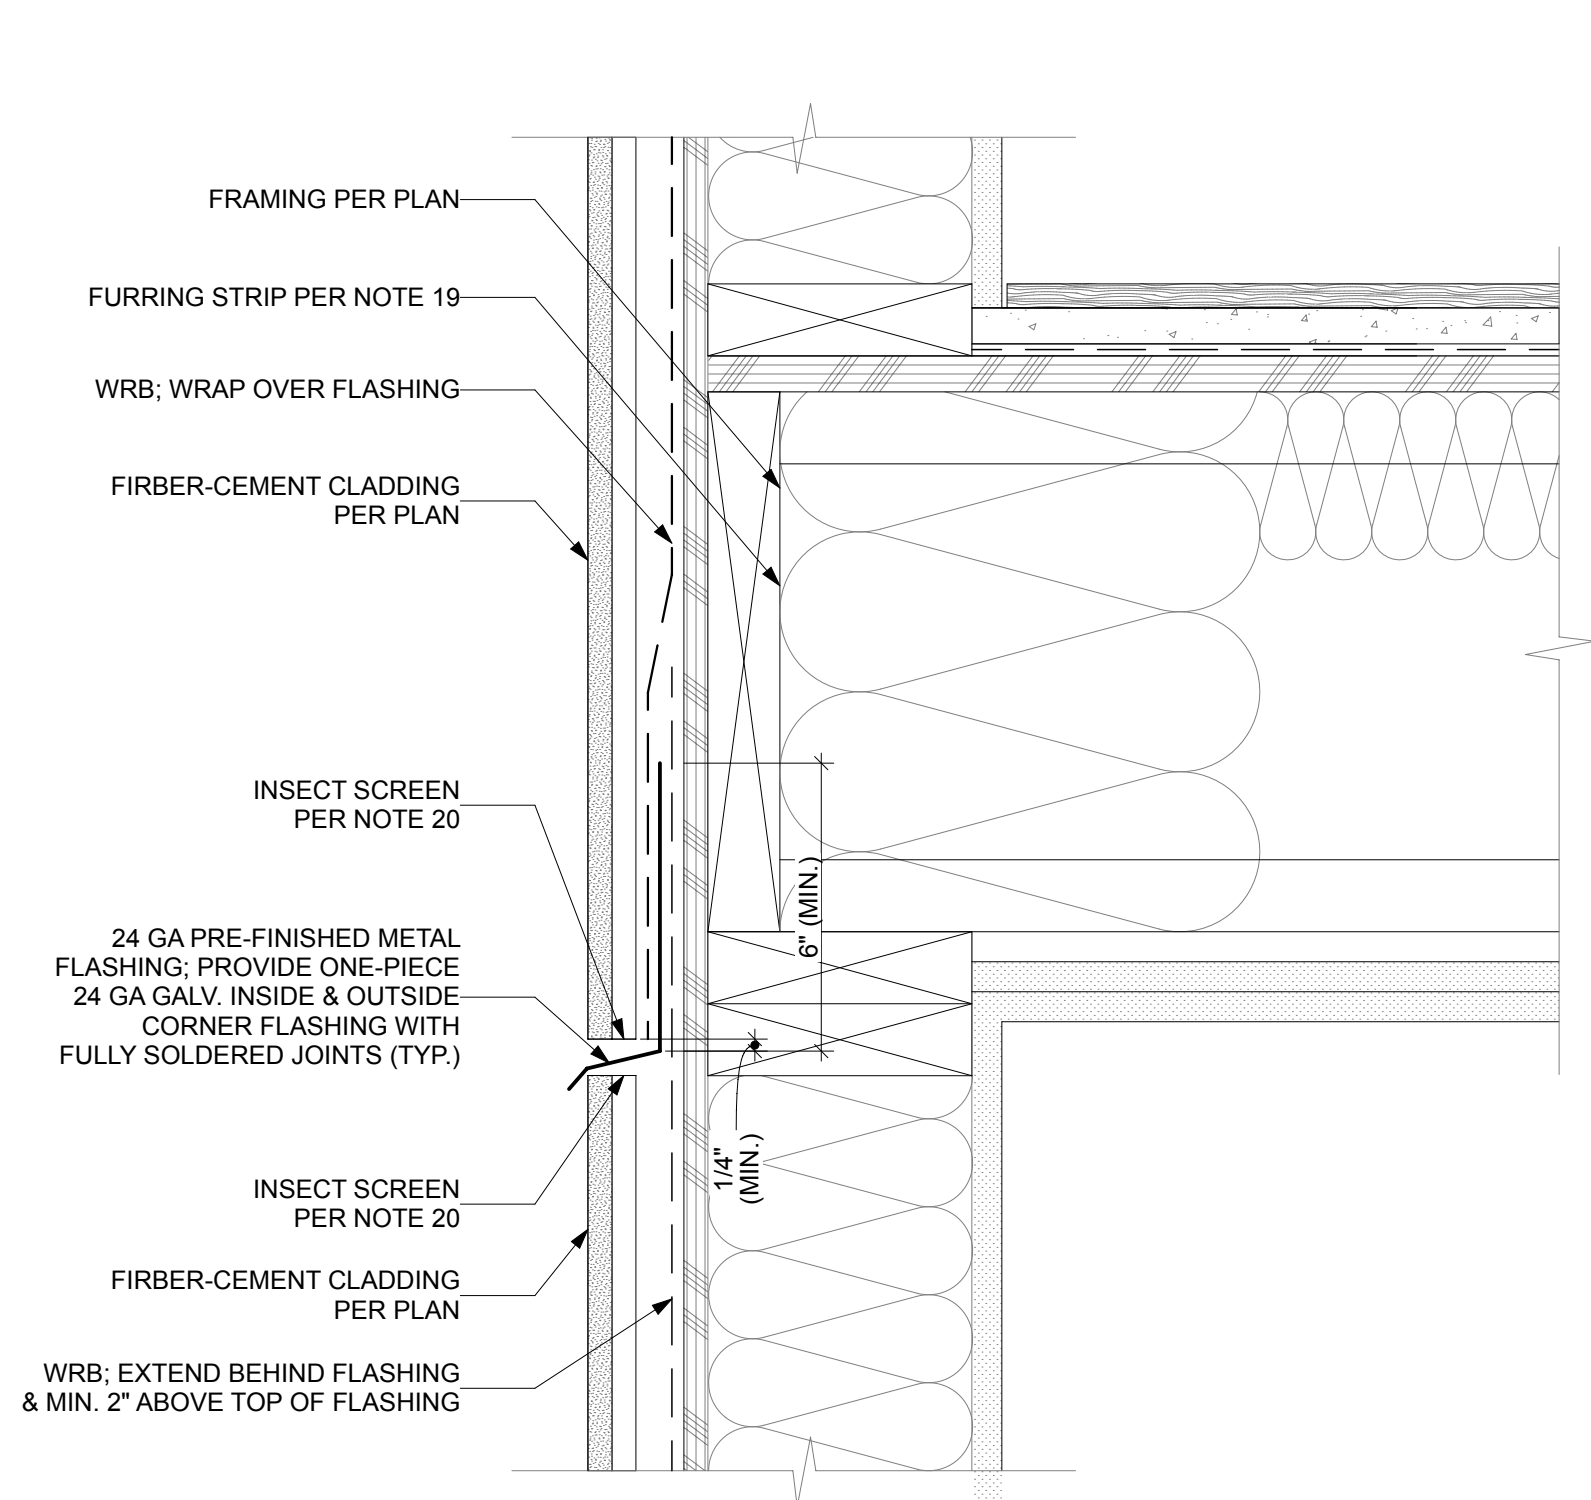

6 THROUGH WALL FLASHING
SCALE: 3" = 1'-0"

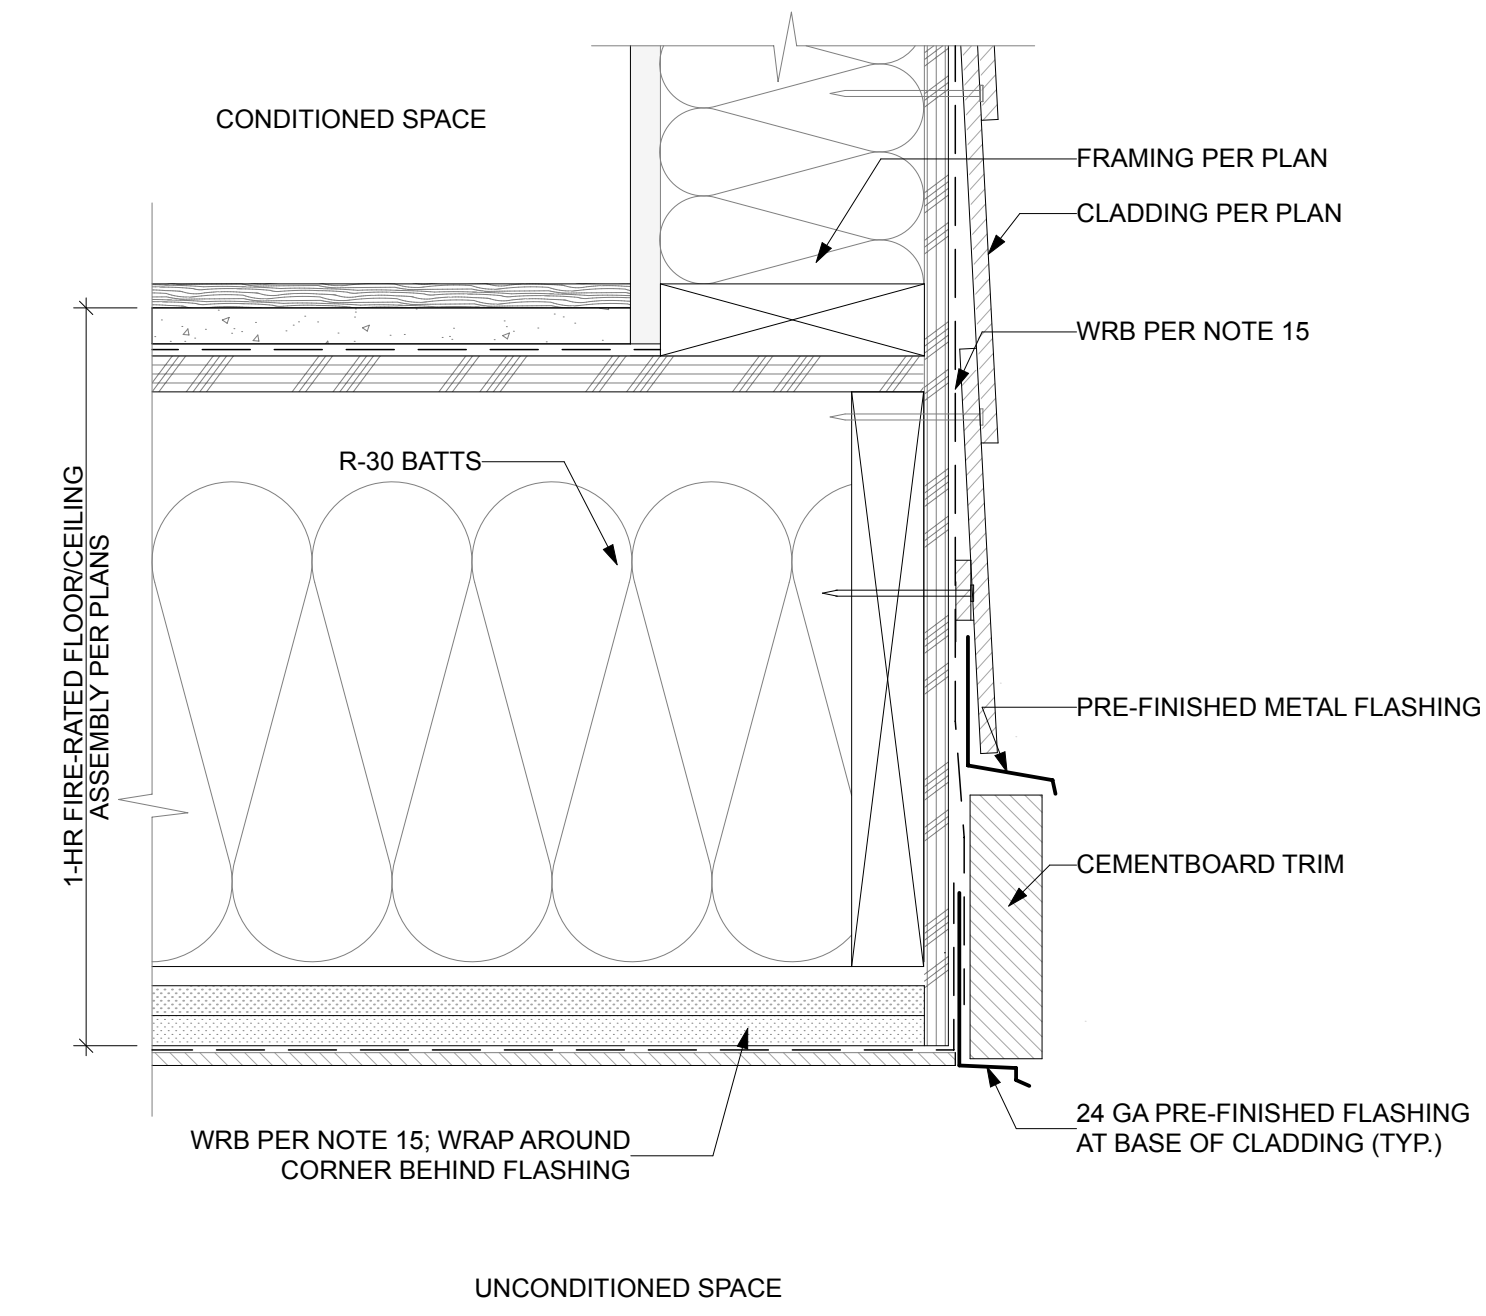


5 BUILDING OVERHANG
SCALE: 3" = 1'-0"

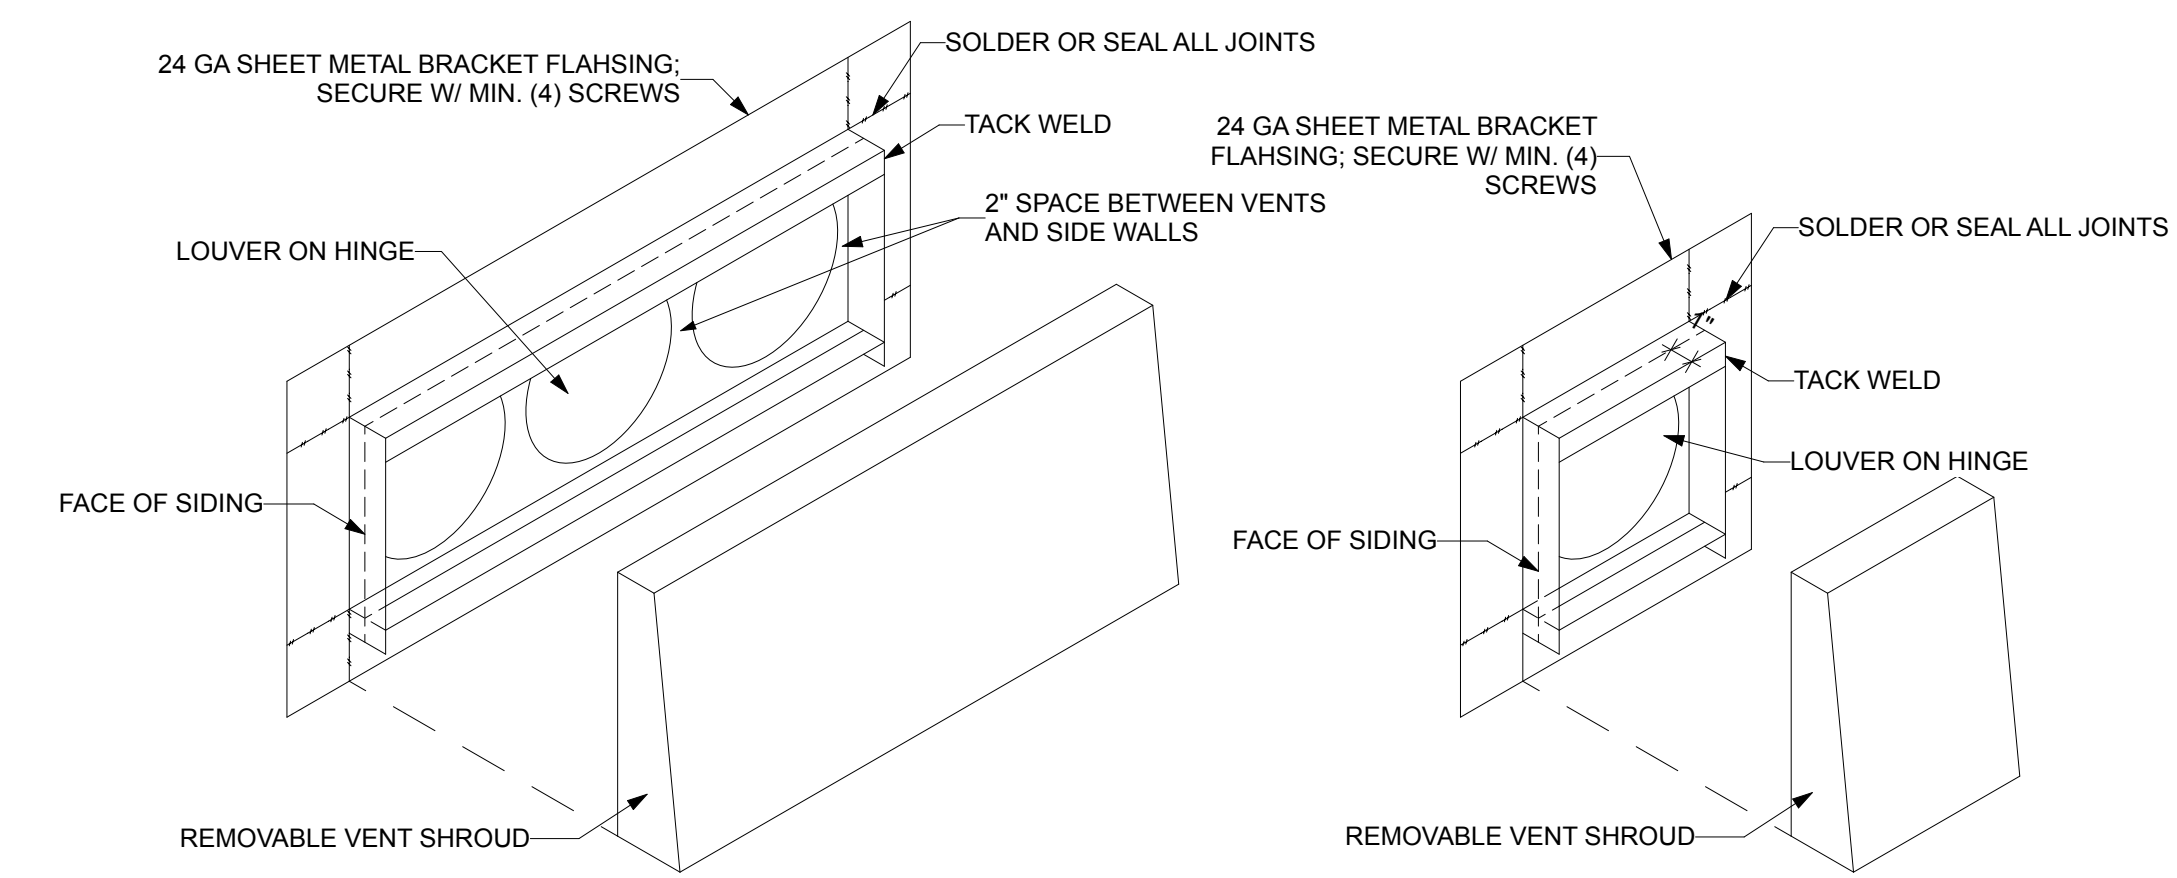

4 VENT SHROUDS
SCALE: 1 1/2" = 1'-0"

REVISIONS	
REVISIONS	
DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	24.03.11
TITLE:	DETAILS
PROJECT #:	2016
SHEET:	

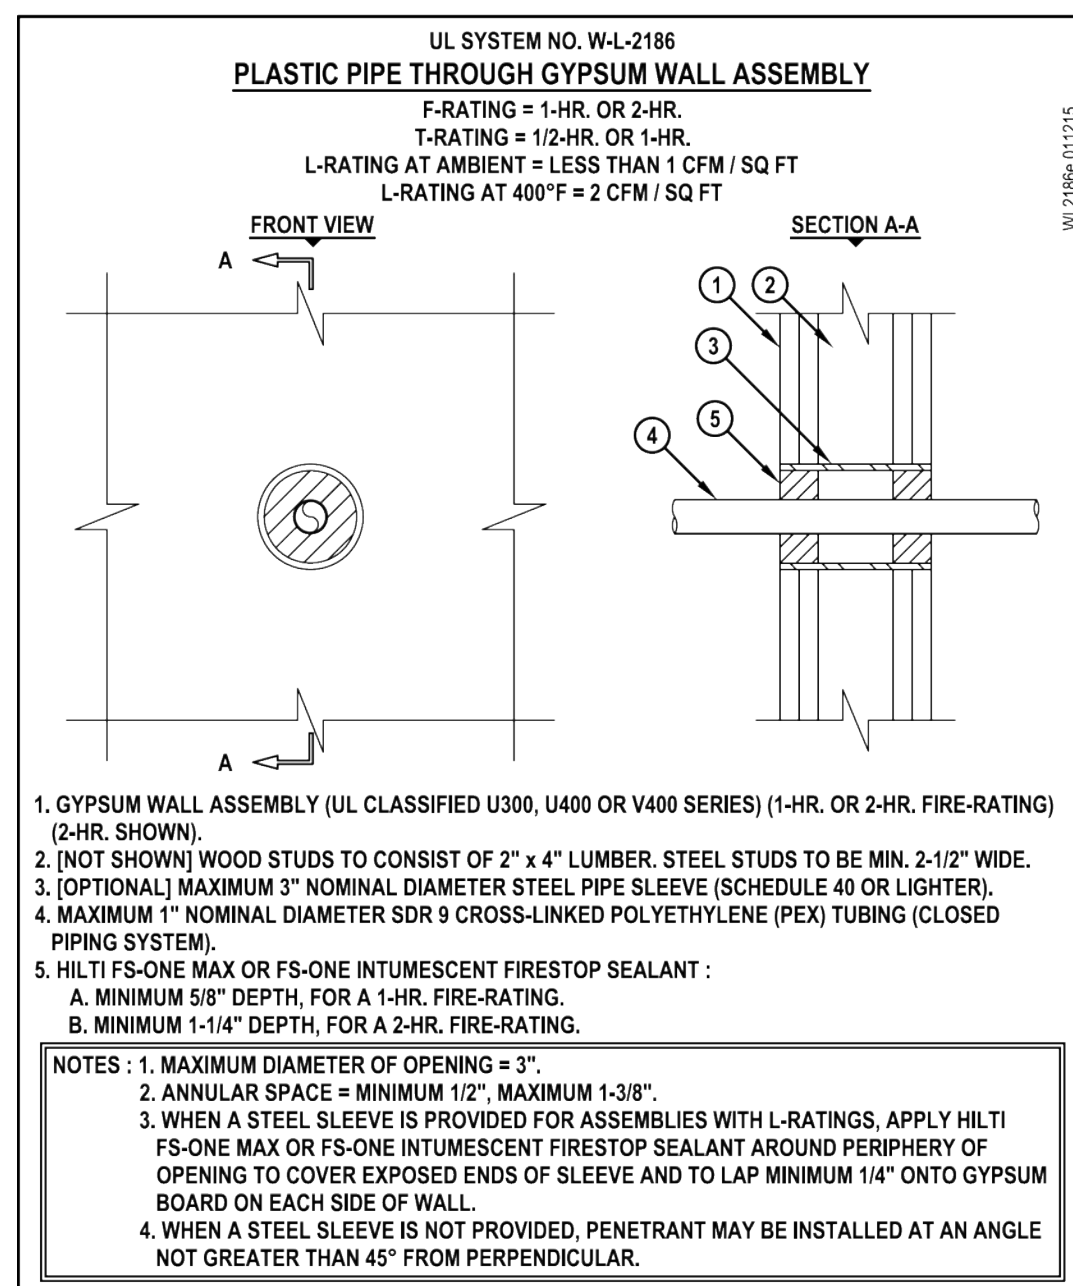


UL SYSTEM NO. W-1-2186
PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 12-HR. OR 1-HR.
 L-RATING AT AMBIENT = LESS THAN 1 CFM / SQ FT
 L-RATING AT 400°F = 2 CFM / SQ FT

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300, U400 OR V400 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. (NOT SHOWN) WOOD STUDS TO CONSIST OF 2" x 4" LUMBER. STEEL STUDS TO BE MIN. 2-1/2" WIDE.
 3. (OPTIONAL) MAXIMUM 3" NOMINAL DIAMETER STEEL PIPE SLEEVE (SCHEDULE 40 OR LIGHTER).
 4. MAXIMUM 1" NOMINAL DIAMETER SDR 9 CROSS-LINKED POLYETHYLENE (PEX) TUBING (CLOSED PIPING SYSTEM).
 5. HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT:
 A. MINIMUM 5/8" DEPTH FOR A 1-HR. FIRE-RATING.
 B. MINIMUM 1-1/4" DEPTH FOR A 2-HR. FIRE-RATING.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 3".
 2. ANNULAR SPACE = MINIMUM 1/2", MAXIMUM 1-3/8".
 3. WHEN A STEEL SLEEVE IS PROVIDED FOR ASSEMBLIES WITH L-RATINGS, APPLY HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT AROUND PERIPHERY OF OPENING TO COVER EXPOSED ENDS OF SLEEVE AND TO LAP MINIMUM 1/4" ONTO GYPSUM BOARD ON EACH SIDE OF WALL.
 4. WHEN A STEEL SLEEVE IS NOT PROVIDED, PENETRANT MAY BE INSTALLED AT AN ANGLE NOT GREATER THAN 45° FROM PERPENDICULAR.

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000
 Scale: 3/16" = 1"
 Date: Jan. 12, 2015
 Drawing No. **WL 2186e**

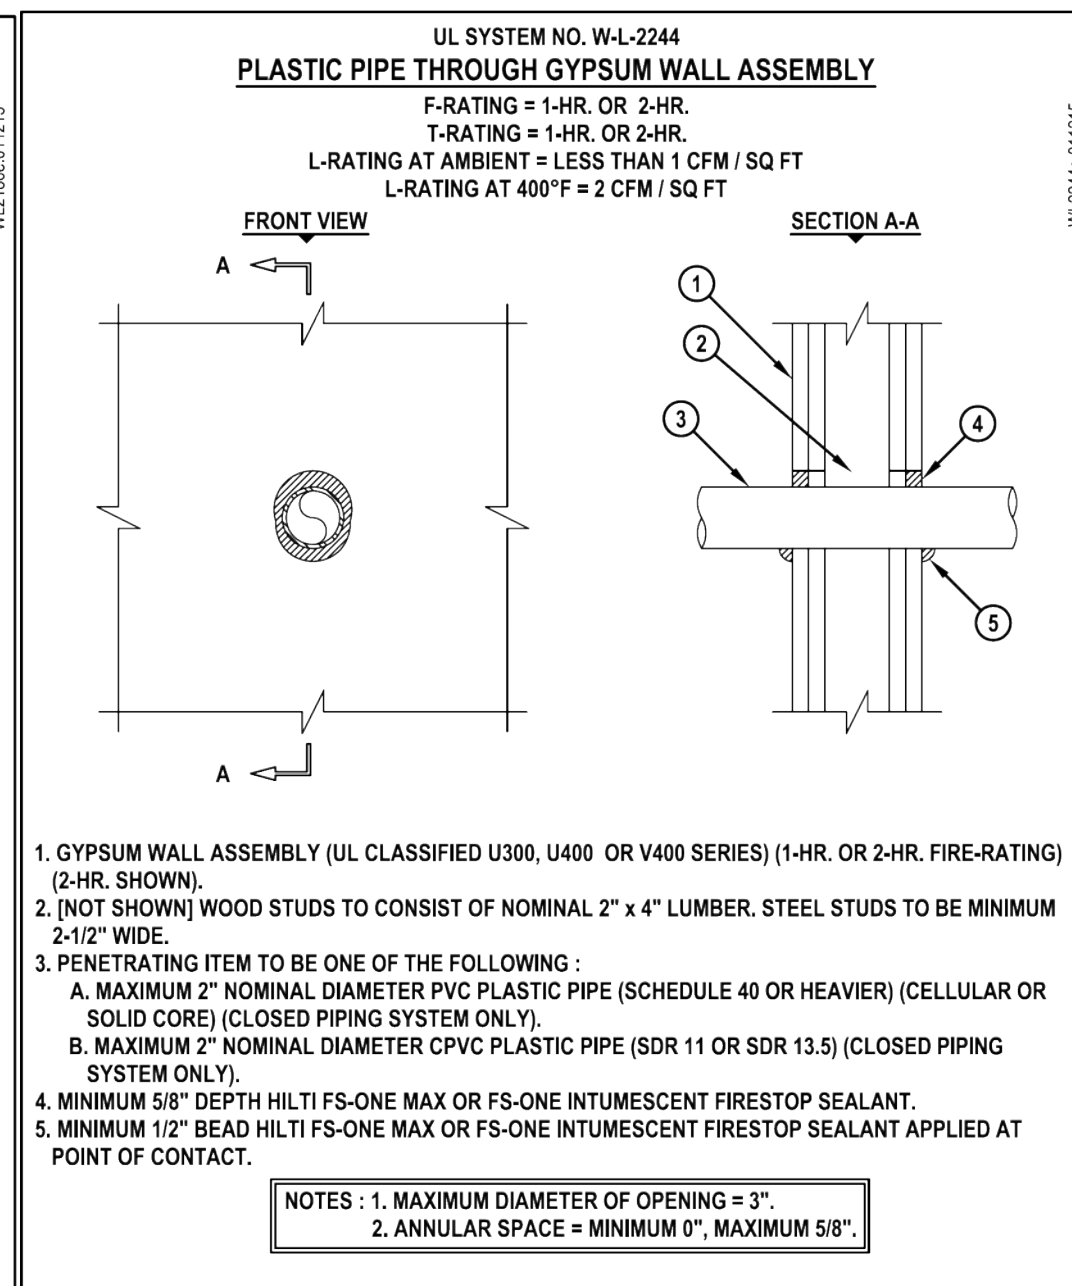


UL SYSTEM NO. W-1-2244
PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 1-HR. OR 2-HR.
 L-RATING AT AMBIENT = LESS THAN 1 CFM / SQ FT
 L-RATING AT 400°F = 2 CFM / SQ FT

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300, U400 OR V400 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. (NOT SHOWN) WOOD STUDS TO CONSIST OF NOMINAL 2" x 4" LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.
 3. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:
 A. MAXIMUM 2" NOMINAL DIAMETER CPVC PLASTIC PIPE (SCHEDULE 40 OR HEAVIER) (CELLULAR OR SOLID CORE) (CLOSED PIPING SYSTEM ONLY).
 B. MAXIMUM 2" NOMINAL DIAMETER CPVC PLASTIC PIPE (SDR 11 OR SDR 13.5) (CLOSED PIPING SYSTEM ONLY).
 4. MINIMUM 5/8" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT.
 5. MINIMUM 1/2" BEAD HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 3".
 2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 5/8".

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000
 Scale: 3/16" = 1"
 Date: Jan. 12, 2015
 Drawing No. **WL 2244e**

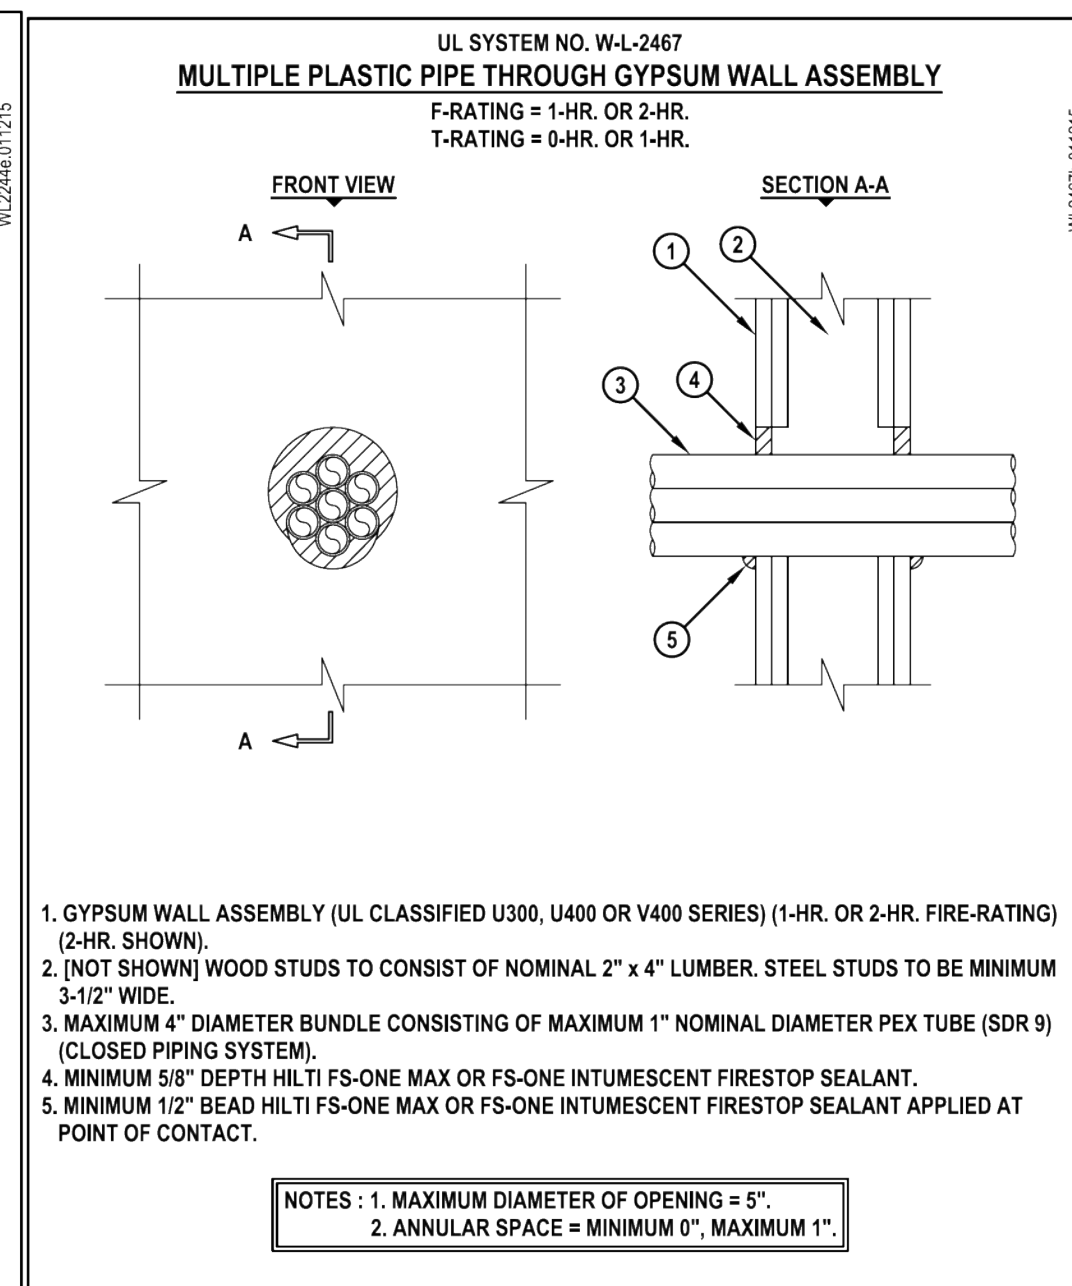


UL SYSTEM NO. W-1-2467
MULTIPLE PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 1-HR. OR 2-HR.
 L-RATING AT AMBIENT = LESS THAN 1 CFM / SQ FT
 L-RATING AT 400°F = 4 CFM / SQ FT

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300, U400 OR V400 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. (NOT SHOWN) WOOD STUDS TO CONSIST OF NOMINAL 2" x 4" LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.
 3. MAXIMUM 4" DIAMETER BUNDLE CONSISTING OF MAXIMUM 1" NOMINAL DIAMETER PEX TUBE (SDR 9) (CLOSED PIPING SYSTEM).
 4. MINIMUM 5/8" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT.
 5. MINIMUM 1/2" BEAD HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 5".
 2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1".

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000
 Scale: 3/16" = 1"
 Date: Jan. 12, 2015
 Drawing No. **WL 2467b**

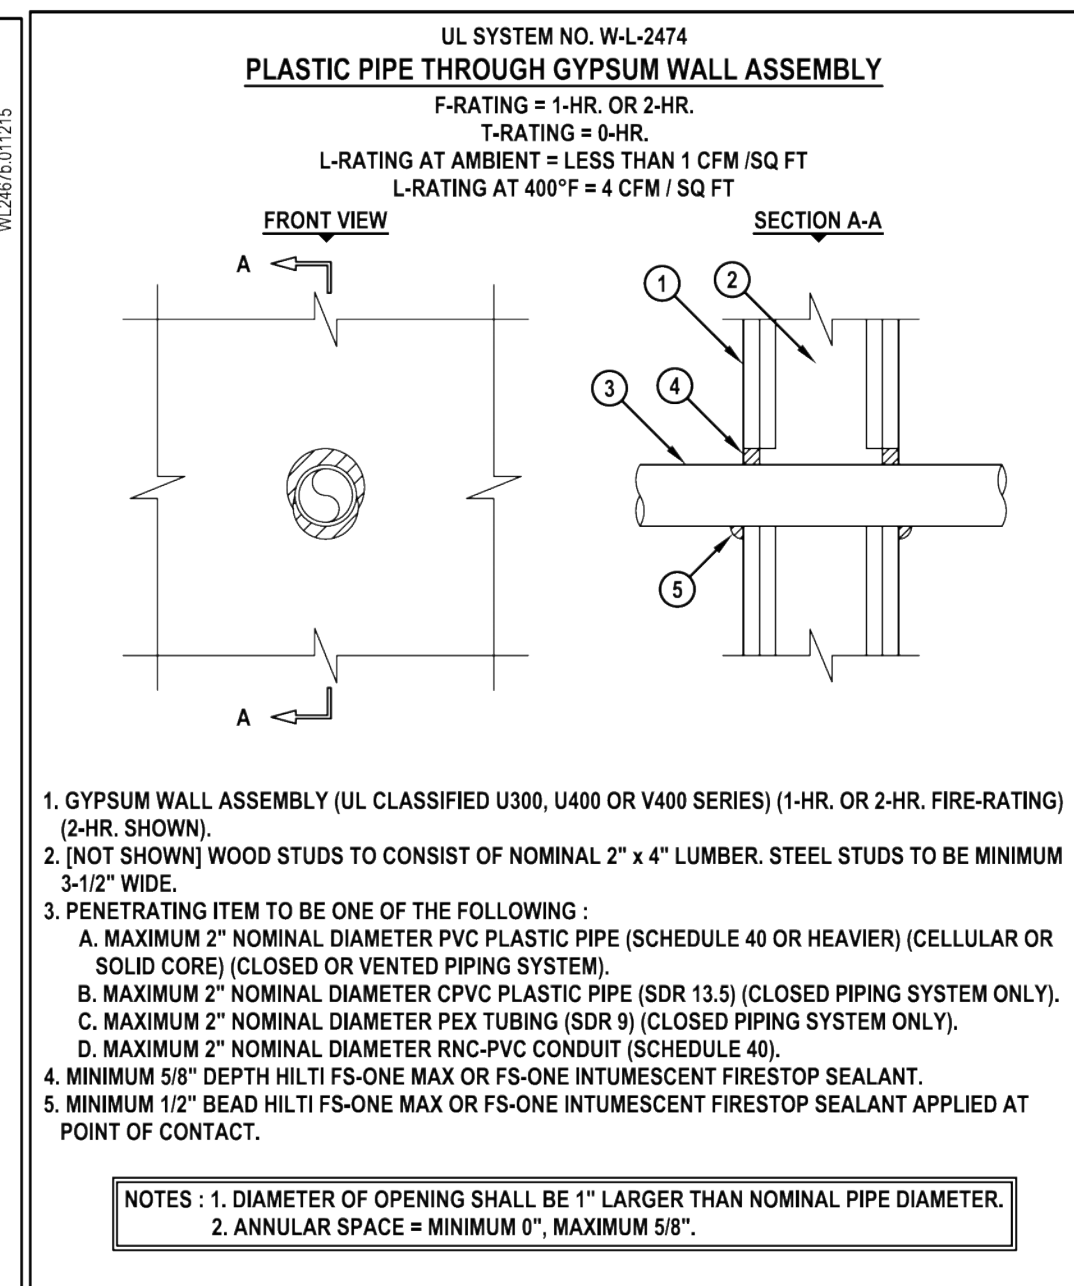


UL SYSTEM NO. W-1-2474
PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 0-HR.
 L-RATING AT AMBIENT = LESS THAN 1 CFM / SQ FT
 L-RATING AT 400°F = 4 CFM / SQ FT

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300, U400 OR V400 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. (NOT SHOWN) WOOD STUDS TO CONSIST OF NOMINAL 2" x 4" LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.
 3. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:
 A. MAXIMUM 2" NOMINAL DIAMETER PVC PLASTIC PIPE (SCHEDULE 40 OR HEAVIER) (CELLULAR OR SOLID CORE) (CLOSED OR VENTED PIPING SYSTEM).
 B. MAXIMUM 2" NOMINAL DIAMETER CPVC PLASTIC PIPE (SDR 13.5) (CLOSED PIPING SYSTEM ONLY).
 C. MAXIMUM 2" NOMINAL DIAMETER PEX TUBING (SDR 9) (CLOSED PIPING SYSTEM ONLY).
 D. MAXIMUM 2" NOMINAL DIAMETER RNC-PVC CONDUIT (SCHEDULE 40).
 4. MINIMUM 5/8" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT.
 5. MINIMUM 1/2" BEAD HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT.

NOTES: 1. DIAMETER OF OPENING SHALL BE 1" LARGER THAN NOMINAL PIPE DIAMETER.
 2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 5/8".

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000
 Scale: 3/16" = 1"
 Date: Jan. 12, 2015
 Drawing No. **WL 2474d**

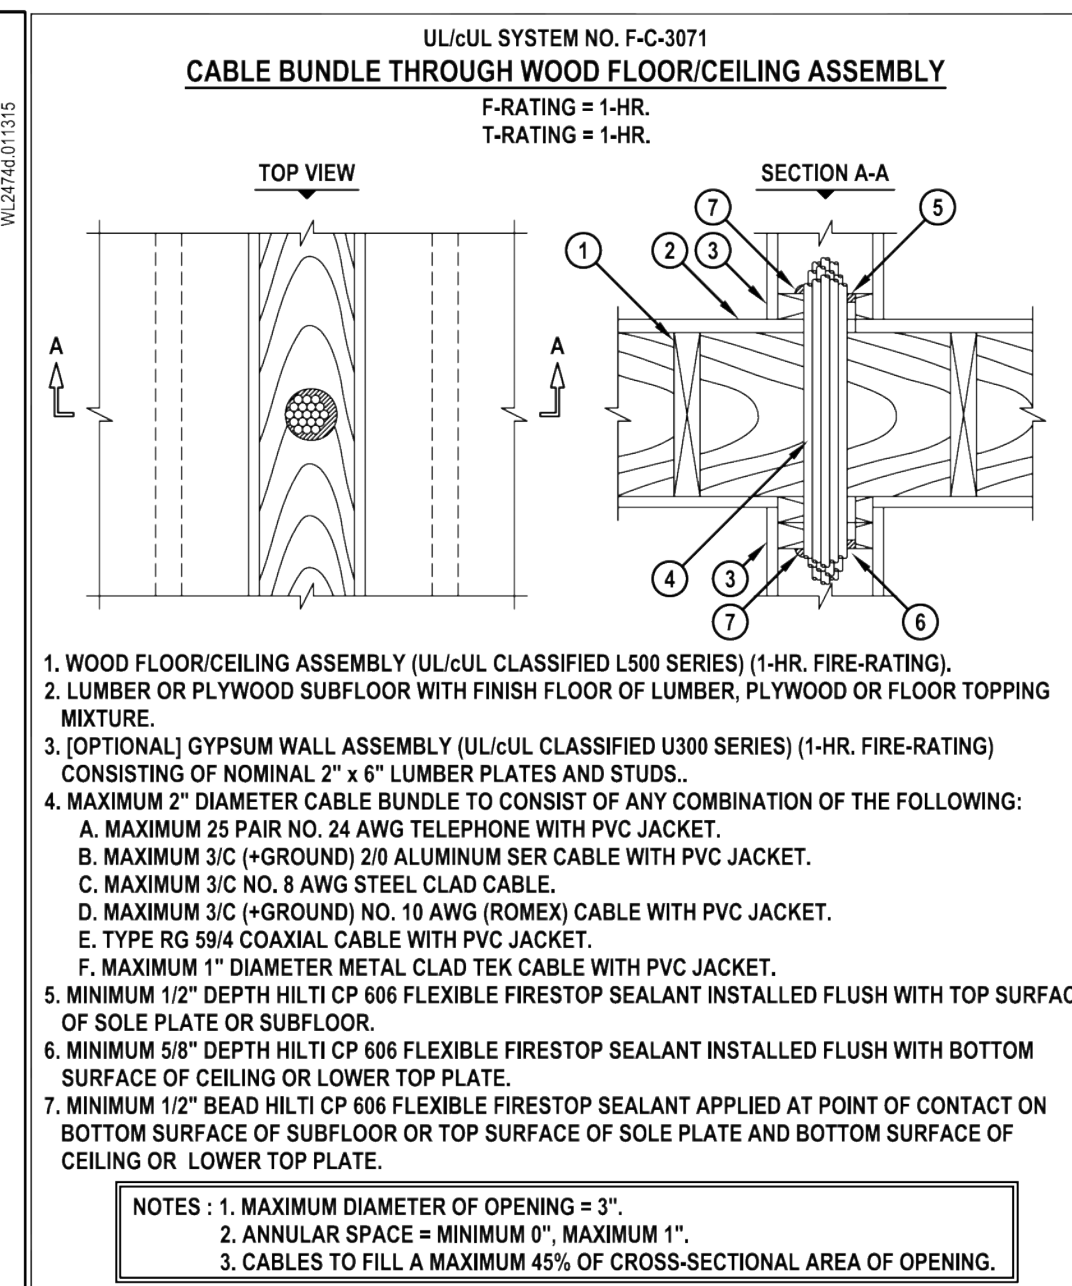


UL SYSTEM NO. F-C-3071
CABLE BUNDLE THROUGH WOOD FLOOR/CEILING ASSEMBLY
 F-RATING = 1-HR.
 T-RATING = 1-HR.

1. WOOD FLOOR/CEILING ASSEMBLY (UL/ULC CLASSIFIED L500 SERIES) (1-HR. FIRE-RATING).
 2. LUMBER OR PLYWOOD SUBFLOOR WITH FINISH FLOOR OF LUMBER, PLYWOOD OR FLOOR TOPPING MIXTURE.
 3. (OPTIONAL) GYPSUM WALL ASSEMBLY (UL/ULC CLASSIFIED U300 SERIES) (1-HR. FIRE-RATING) CONSISTING OF NOMINAL 2" x 4" LUMBER PLATES AND STUDS.
 4. MAXIMUM 2" DIAMETER CABLE BUNDLE TO CONSIST OF ANY COMBINATION OF THE FOLLOWING:
 A. MAXIMUM 25 PAIR NO. 12 AWG TELEPHONE CABLE WITH PVC JACKET.
 B. MAXIMUM 3" (+GROUND) 20 ALUMINUM SER CABLE WITH PVC JACKET.
 C. MAXIMUM 3/4" NO. 8 AWG STEEL CLAD CABLE.
 D. MAXIMUM 3/4" (+GROUND) NO. 10 AWG (ROMEX) CABLE WITH PVC JACKET.
 E. TYPE RG 59/4 COAXIAL CABLE WITH PVC JACKET.
 F. MAXIMUM 1" DIAMETER METAL CLAD TEB CABLE WITH PVC JACKET.
 5. MINIMUM 1/2" BEAD HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT INSTALLED FLUSH WITH TOP SURFACE OF SOLE PLATE OR SUBFLOOR.
 6. MINIMUM 3/4" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT INSTALLED FLUSH WITH TOP SURFACE OF CEILING OR LOWER TOP PLATE.
 7. MINIMUM 1/2" BEAD HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT ON BOTTOM SURFACE OF SUBFLOOR OR TOP SURFACE OF SOLE PLATE AND BOTTOM SURFACE OF CEILING OR LOWER TOP PLATE.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 3".
 2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1".
 3. CABLES TO FILL A MAXIMUM 45% OF CROSS-SECTIONAL AREA OF OPENING.

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000
 Scale: 1/8" = 1"
 Date: Sep. 27, 2007
 Drawing No. **FC 3071d**

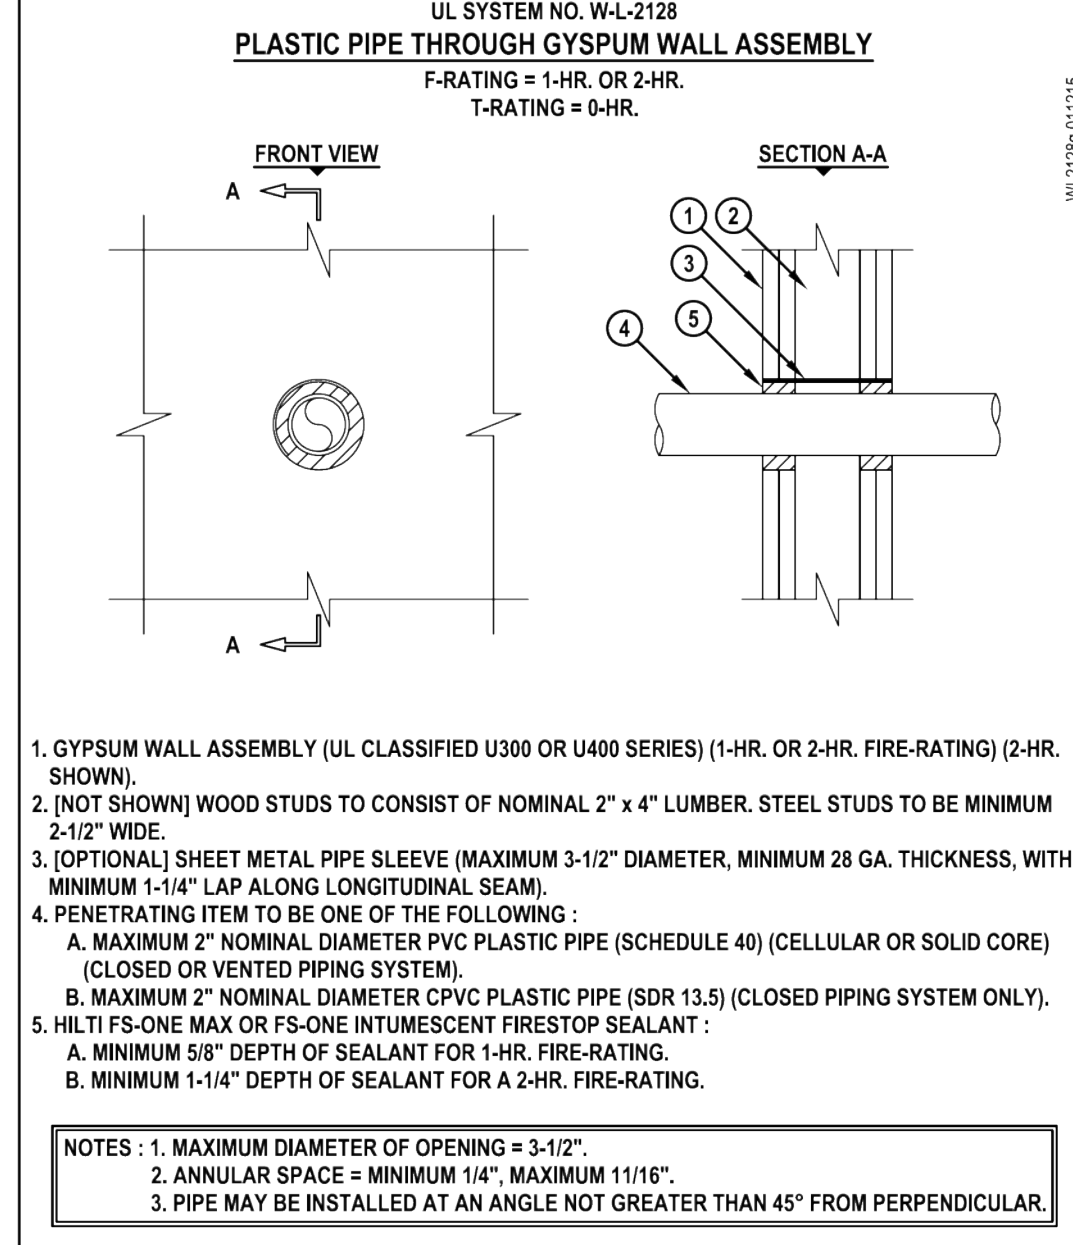


UL SYSTEM NO. W-1-2128
PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 0-HR.

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 OR U400 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. (NOT SHOWN) WOOD STUDS TO CONSIST OF NOMINAL 2" x 4" LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.
 3. (OPTIONAL) SHEET METAL PIPE SLEEVE (MAXIMUM 3-1/2" DIAMETER, MINIMUM 28 GA. THICKNESS, WITH MINIMUM 1-1/4" LAP ALONG LONGITUDINAL SEAM).
 4. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:
 A. MAXIMUM 2" NOMINAL DIAMETER CPVC PLASTIC PIPE (SCHEDULE 40) (CELLULAR OR SOLID CORE) (CLOSED OR VENTED PIPING SYSTEM).
 B. MAXIMUM 2" NOMINAL DIAMETER CPVC PLASTIC PIPE (SDR 13.5) (CLOSED PIPING SYSTEM ONLY).
 5. HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT:
 A. MINIMUM 5/8" DEPTH OF SEALANT FOR 1-HR. FIRE-RATING.
 B. MINIMUM 1-1/4" DEPTH OF SEALANT FOR 2-HR. FIRE-RATING.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 3-1/2".
 2. ANNULAR SPACE = MINIMUM 1/4", MAXIMUM 1-1/16".
 3. PIPE MAY BE INSTALLED AT AN ANGLE NOT GREATER THAN 45° FROM PERPENDICULAR.

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000
 Scale: 3/16" = 1"
 Date: Jan. 12, 2015
 Drawing No. **WL 2128g**

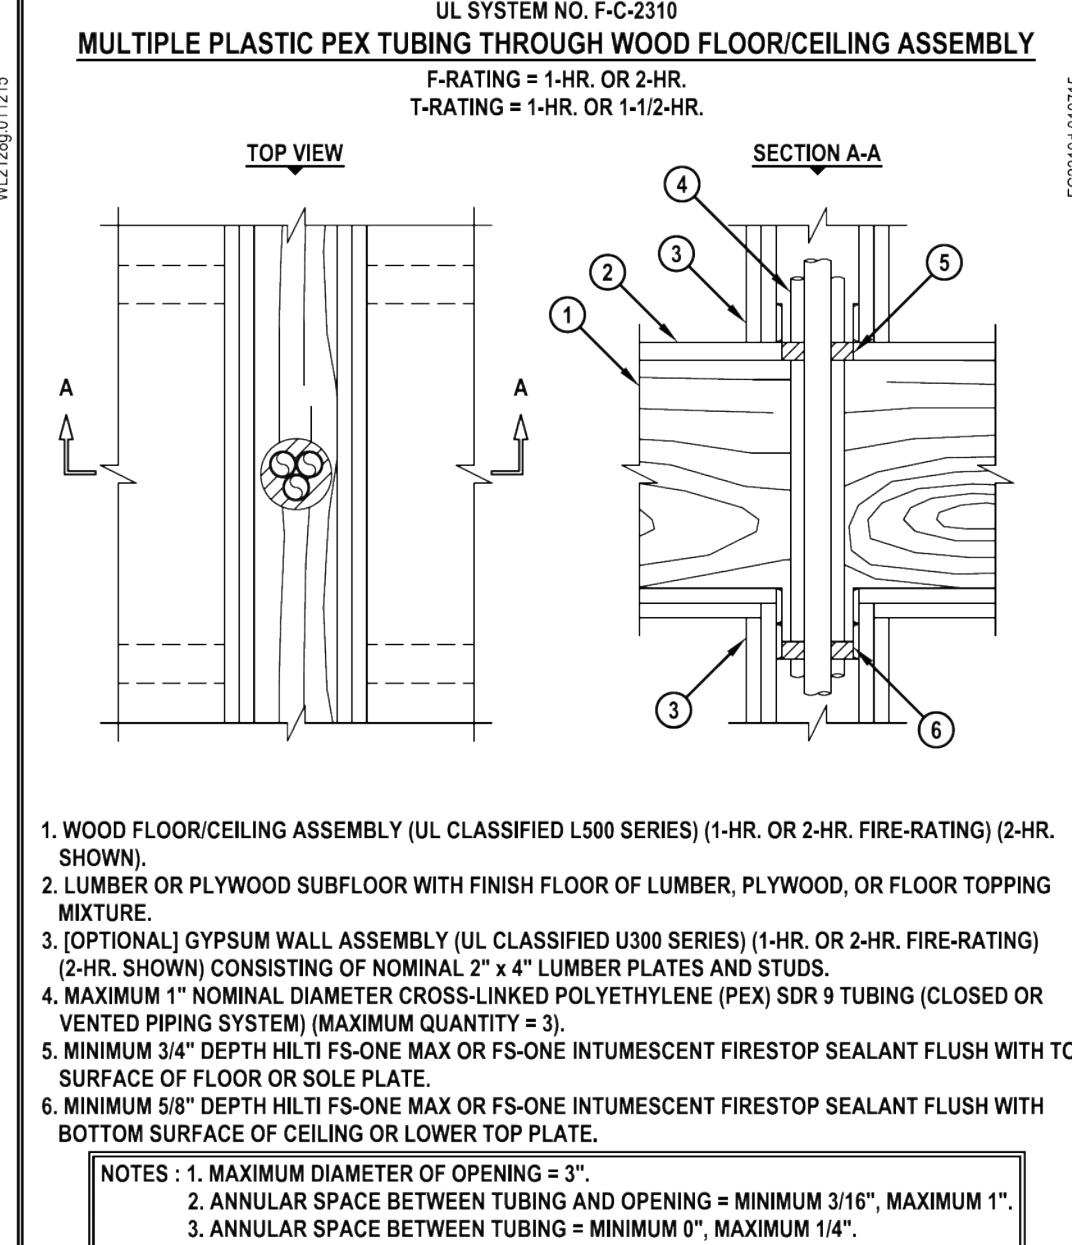


UL SYSTEM NO. F-C-2310
MULTIPLE PLASTIC PEX TUBING THROUGH WOOD FLOOR/CEILING ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 1-HR. OR 1-1/2-HR.

1. WOOD FLOOR/CEILING ASSEMBLY (UL CLASSIFIED L500 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. LUMBER OR PLYWOOD SUBFLOOR WITH FINISH FLOOR OF LUMBER, PLYWOOD, OR FLOOR TOPPING MIXTURE.
 3. (OPTIONAL) GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN) CONSISTING OF NOMINAL 2" x 4" LUMBER PLATES AND STUDS.
 4. MAXIMUM 1" NOMINAL DIAMETER CROSS-LINKED POLYETHYLENE (PEX) SDR 9 TUBING (CLOSED OR VENTED PIPING SYSTEM) (MAXIMUM QUANTITY = 3).
 5. MINIMUM 3/4" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT FLUSH WITH TOP SURFACE OF FLOOR OR SOLE PLATE.
 6. MINIMUM 5/8" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT FLUSH WITH BOTTOM SURFACE OF CEILING OR LOWER TOP PLATE.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 3".
 2. ANNULAR SPACE BETWEEN TUBING AND OPENING = MINIMUM 3/16", MAXIMUM 1".
 3. ANNULAR SPACE BETWEEN TUBING = MINIMUM 0", MAXIMUM 1/4".

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000
 Scale: 1/16" = 1"
 Date: Jan. 07, 2015
 Drawing No. **FC 2310d**

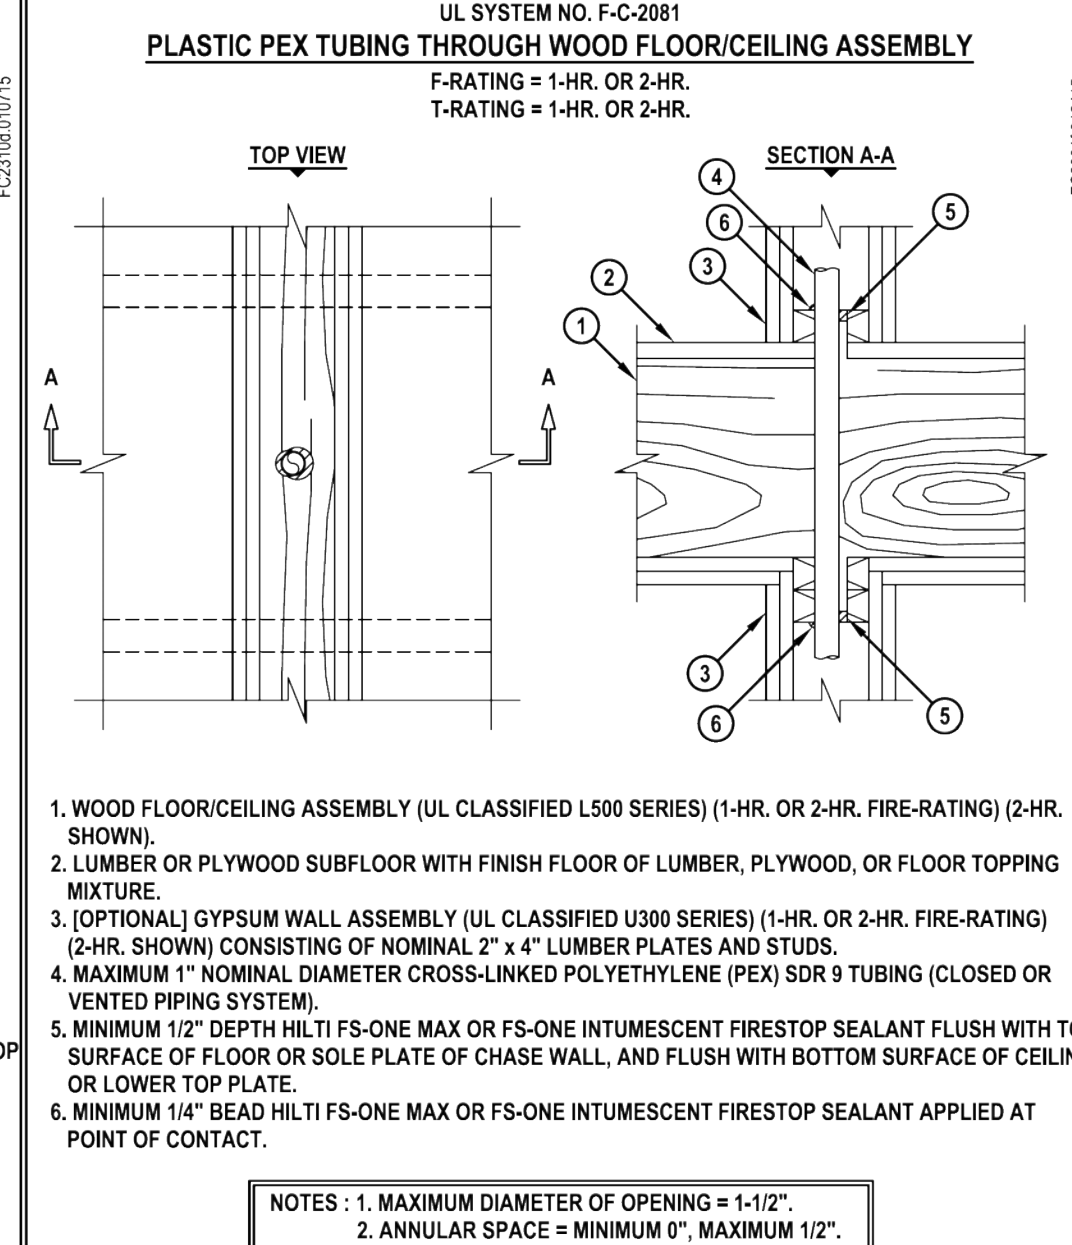

UL SYSTEM NO. F-C-2081
PLASTIC PEX TUBING THROUGH WOOD FLOOR/CEILING ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 1-HR. OR 2-HR.

1. WOOD FLOOR/CEILING ASSEMBLY (UL CLASSIFIED L500 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. LUMBER OR PLYWOOD SUBFLOOR WITH FINISH FLOOR OF LUMBER, PLYWOOD, OR FLOOR TOPPING MIXTURE.
 3. (OPTIONAL) GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN) CONSISTING OF NOMINAL 2" x 4" LUMBER PLATES AND STUDS.
 4. MAXIMUM 1" NOMINAL DIAMETER CROSS-LINKED POLYETHYLENE (PEX) SDR 9 TUBING (CLOSED OR VENTED PIPING SYSTEM).
 5. MINIMUM 1/2" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT FLUSH WITH TOP SURFACE OF FLOOR OR SOLE PLATE AND FLUSH WITH BOTTOM SURFACE OF CEILING OR LOWER TOP PLATE.
 6. MINIMUM 1/4" BEAD HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT.


NOTES: 1. MAXIMUM DIAMETER OF OPENING = 1-1/2".
 2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1/2".

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000
 Scale: 3/16" = 1"
 Date: Jan. 24, 2015
 Drawing No. **FC 2081f**

TYPE OF PENETRANT	F-RATING (HR)	BASIS OF DESIGN UL SYSTEM				Hilti Products
		CONCRETE FLOORS	CONCRETE OR BLOCK WALLS	GYPSUM WALLS	WOOD FLOORS	
CIRCULAR BLANK OPENINGS	1	F-A-0006, C-AJ-0055, C-AJ-0090	C-AJ-0055, C-AJ-0090	---	---	CP 680, CP 618, FS One Max, Firestop Block (CFS-Bl)
	2	F-A-0006, C-AJ-0055, C-AJ-0090	C-AJ-0055, C-AJ-0090	---	---	---
	3	F-A-0006, C-AJ-0055, C-AJ-0090, F-A-0014	C-AJ-0055, C-AJ-0090	---	---	---
METAL PIPES OR CONDUIT	1	C-AJ-1226, F-A-1028, F-A-1017	C-AJ-1226, W-J-1067, W-J-1020	---	---	F-C-1009, F-C-1059, F-C-1168
	2	C-AJ-1226, F-A-1028, F-A-1017	C-AJ-1226, W-J-1067, W-J-1020, W-J-1248	W-L-1054, W-L-1056, W-L-1164, W-L-1506	---	F-C-1009, F-C-1059, F-C-1168
	3	C-AJ-1226, F-A-1017	C-AJ-1226, W-J-1041, W-J-1068	---	---	---
	4	C-BJ-1037, C-BJ-1034	C-BJ-1034, C-BJ-1037, W-J-1041, W-J-1042, W-J-1068	W-L-1110, W-L-1111, W-L-1165	---	---
NON-METALLIC PIPE OR CONDUIT (I.E. PVC, CPVC, ABS, FRP, ENT)	1	F-A-2051, F-A-2025, C-AJ-2109, C-AJ-2098, C-AJ-2271, C-AJ-2167, C-AJ-2021, C-AJ-2342	C-AJ-2109, C-AJ-2098, C-AJ-2167, C-AJ-2342	---	---	---
	2	F-A-2051, F-A-2025, C-AJ-2109, C-AJ-2098, C-AJ-2271, C-AJ-2167, C-AJ-2021, C-AJ-2342	C-AJ-2109, C-AJ-2098, C-AJ-2167, C-AJ-2342	W-L-2078, W-L-2075, W-L-2128	---	F-C-2025, F-C-2030, F-C-2128, C-2189
	3	F-A-2054, C-AJ-2109, C-AJ-2098, C-AJ-2371, C-AJ-2342	C-AJ-2109, C-AJ-2098, C-AJ-2371, C-AJ-2342	---	---	---
	4	C-BJ-2016, C-AJ-2017	W-J-2057, W-J-2091	---	---	---
SINGLE OR BUNDLED CABLES	1	F-A-3007, C-AJ-3095, C-AJ-3180, C-AJ-3283	W-J-3036, C-AJ-3095, C-AJ-3180, W-J-3060, W-J-3167	W-L-3065, W-L-3111, W-L-3112, W-L-3334, W-L-3414, W-L-3399	---	F-C-3012, F-C-3110, F-C-3044
	2	F-A-3007, C-AJ-3095, C-AJ-3334, F-A-3060	W-J-3036, C-AJ-3095, C-AJ-3180, W-J-3060, W-J-3167, W-L-3189	---	---	---
	3	F-A-3007, C-AJ-3095, C-AJ-3285	C-AJ-3095, C-AJ-3180, W-J-3167	---	---	---
	4	N/A**	W-J-3050	---	---	---
CABLE TRAY	1	C-AJ-4034, C-AJ-4035	W-J-4027, C-AJ-4034, C-AJ-4035	W-L-4011, W-L-4019, W-L-4081	---	Firestop Block (CFS-Bl), FS One Max, Foam (CP 620), CP 618
	2	C-AJ-4034, C-AJ-4035	W-J-4027, C-AJ-4034, C-AJ-4035	---	---	---
	3	C-AJ-4034, C-AJ-4035	---	---	---	---
	4	N/A**	W-J-8007	W-L-8014	---	---
INSULATED PIPES	1	F-A-5015, F-A-5017, C-AJ-5050, C-AJ-5091, C-AJ-5050, C-AJ-5048	C-AJ-5090, C-AJ-5091, C-AJ-5061, W-J-5047	W-L-5028, W-L-5029, W-L-5047	---	F-C-5004, F-C-5037, F-C-5036
	2	F-A-5015, F-A-5017, C-AJ-5090, C-AJ-5091, C-AJ-5090	C-AJ-5090, C-AJ-5091, C-AJ-5061, W-J-5047	---	---	---
	3	F-A-5016, C-AJ-5050, F-A-5016	C-AJ-5090, C-AJ-5061	---	---	---
	4	C-BJ-5006	C-BJ-5006, W-J-5028	W-L-5073	---	---
ELECTRICAL BUSWAY	1	C-AJ-6036, C-AJ-6017, F-A-6042, C-AJ-6036	C-AJ-6036, C-AJ-6017, C-AJ-6036	---	---	---
	2	C-AJ-6036, C-AJ-6017, F-A-6042, C-AJ-6036	C-AJ-6036, C-AJ-6017, C-AJ-6036	---	---	---
	3	C-AJ-6036, C-AJ-6017	C-AJ-6036, C-AJ-6017	---	---	---
MECHANICAL DUCTWORK WITHOUT DAMPERS (NON-INSULATED)	1	C-AJ-7046, C-AJ-7051, C-AJ-7094	C-AJ-7046, C-AJ-7051, W-J-7021, W-J-7022	W-L-7017, W-L-7040, W-L-7042, W-L-7155	---	F-C-7013
	2	C-AJ-7046, C-AJ-7051, C-AJ-7094	C-AJ-7046, C-AJ-7051, W-J-7021, W-J-7022	---	---	---
	3	C-AJ-7046, C-AJ-7051	C-AJ-7046, C-AJ-7051	---	---	---
MECHANICAL DUCTWORK WITHOUT DAMPERS (INSULATED)	1	N/A**	W-J-7029, W-J-7124	W-L-7059, W-L-7153, W-L-7156, W-L-7151	---	---
	2	N/A**	W-J-7091, W-J-7112, W-J-7124	---	---	---
	3	C-AJ-8099, C-AJ-8056, C-AJ-8143	C-AJ-8099, C-AJ-8056, W-J-8007, C-AJ-8143	W-L-1095, W-L-1013	---	F-C-8009, F-C-8014, F-C-8026
MIXED PENETRANTS	1	C-AJ-8099, C-AJ-8056, C-AJ-8143	C-AJ-8099, C-AJ-8056, W-J-8007, C-AJ-8143	---	---	---
	2	C-AJ-8099, C-AJ-8056, C-AJ-8143	C-AJ-8099, C-AJ-8056, W-J-8007, C-AJ-8143	---	---	---
	3	C-AJ-8099, C-AJ-8056	C-AJ-8099, C-AJ-8056, W-J-8007, C-AJ-8099	---	---	---

*CONTACT HILTI FOR CURRENT UL CLASSIFIED SYSTEM OR ENGINEER JUDICIAL DRAWING: 800-879-8000

NOTES:
 1. Job site conditions of each through-penetration firestop system must meet ALL details of the UL Classified system selected.
 2. If job site conditions do not match any UL classified systems in the schedules above, contact Hilti for alternative systems or Engineer Judicial Drawings - 800-879-8000
 3. Where more than one applicable UL Classified system is listed in the schedules, the UL System which is most economical for each through-penetration firestop system.
 4. Coordinate work with other trades to assure that penetration opening sizes are appropriate for penetrant locations, and vice versa.

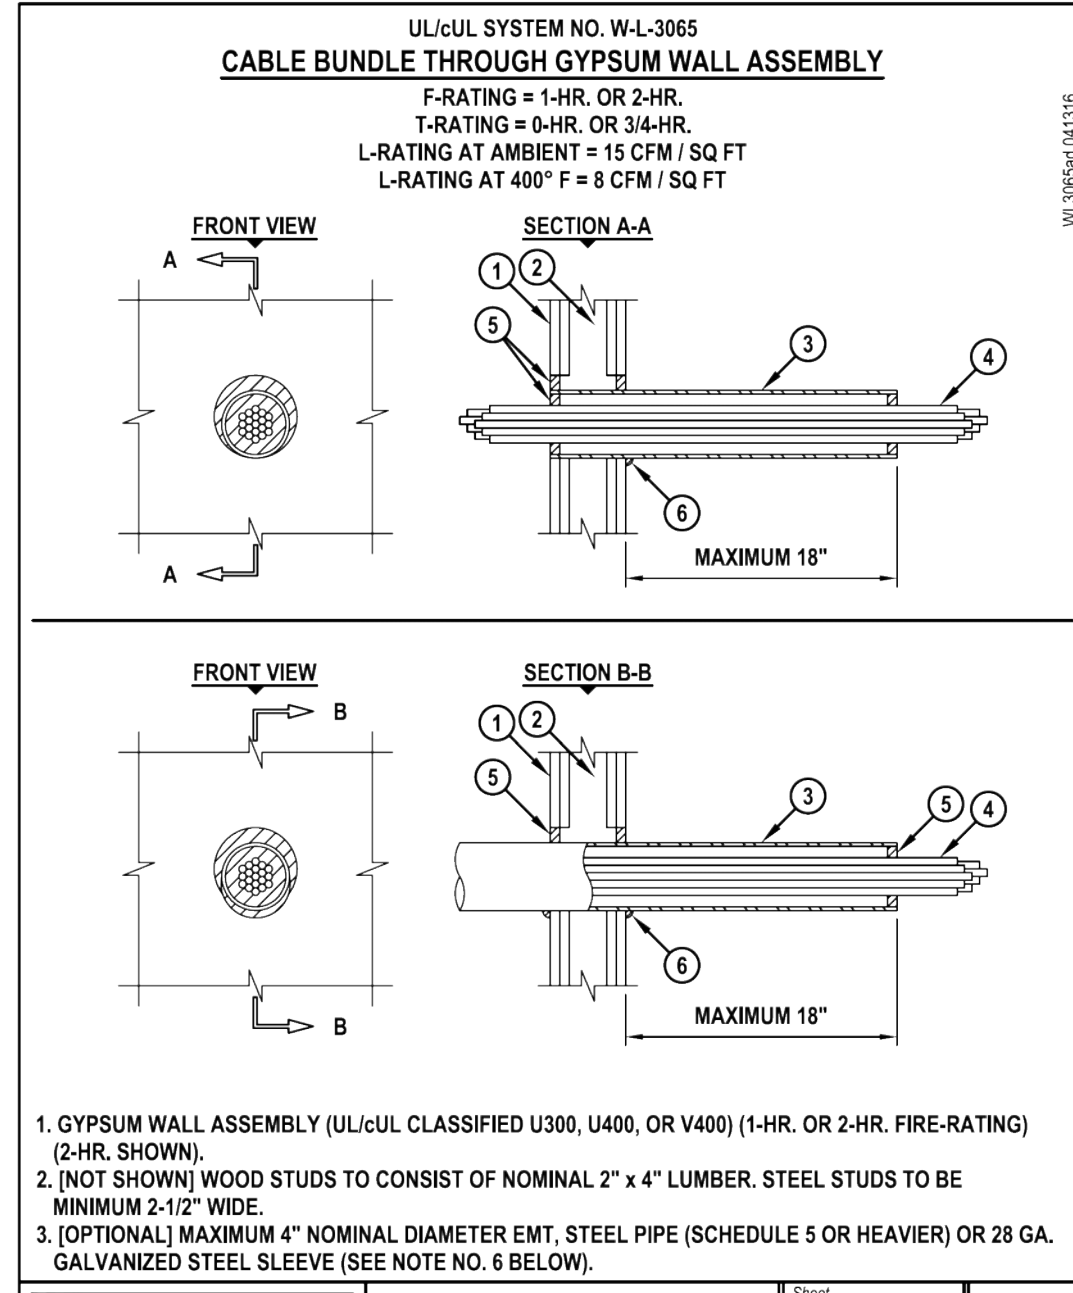


UL SYSTEM NO. W-1-3065
CABLE BUNDLE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 0-HR. OR 3/4-HR.
 L-RATING AT AMBIENT = 15 CFM / SQ FT
 L-RATING AT 400°F = 8 CFM / SQ FT

1. GYPSUM WALL ASSEMBLY (UL/ULC CLASSIFIED U300, U400, OR V400) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. (NOT SHOWN) WOOD STUDS TO CONSIST OF NOMINAL 2" x 4" LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.
 3. (OPTIONAL) MAXIMUM 4" NOMINAL DIAMETER ENT, STEEL PIPE (SCHEDULE 5 OR HEAVIER) OR 28 GA. GALVANIZED STEEL SLEEVE (SEE NOTE NO. 6 BELOW).
 4. CABLE BUNDLE TO CONSIST OF ANY COMBINATION OF THE FOLLOWING (SEE NOTE NO. 5 BELOW):
 A. MAXIMUM 7/8" NO. 12 AWG POWER CABLE WITH PVC JACKET.
 B. MAXIMUM 25 PAIR NO. 24 AWG TELEPHONE CABLE WITH PVC JACKET.
 C. MAXIMUM 1/2" DIAMETER RGU COAXIAL CABLE WITH PVC JACKET.
 D. MAXIMUM 3/4" NO. 8 AWG METAL-CLAD CABLE.
 E. MAXIMUM 3/4" (+GROUND) NO. 8 AWG COPPER CONDUCTOR CABLE (ROMEX).
 F. MAXIMUM 5/8" DIAMETER FIBER-OPTIC CABLE WITH PVC JACKET.
 G. MAXIMUM 3/4" DIAMETER COPPER GROUND CABLE WITH OR WITHOUT PVC JACKET.
 H. MAXIMUM 1-1/4" DIAMETER SINGLE OR MULTIPLE CONDUCTOR TYPE MI CABLE (SEE NOTE NO. 4 BELOW).
 I. ANY CABLES, METAL-CLAD CABLES, OR ARMORED CABLES CURRENTLY LISTED UNDER THE THROUGH PENETRATING PRODUCTS CATEGORY.
 J. MAXIMUM 4/8" (+GROUND) NO. 300 KVMIL ALUMINUM SER CABLE.
 K. MAXIMUM 4 PAIR NO. 22 AWG CAT 5 OR CAT 6 CABLE.
 L. MAXIMUM RG 6/U COAXIAL CABLE WITH FLUORINATED ETHYLENE JACKET.
 5. MINIMUM 5/8" DEPTH HILTI FS-ONE MAX INTUMESCENT FIRESTOP SEALANT, CP 606 FLEXIBLE FIRESTOP SEALANT, OR CP 618 FIRESTOP PUTTY STICK.
 6. MINIMUM 1/2" BEAD HILTI FS-ONE MAX INTUMESCENT FIRESTOP SEALANT, CP 606 FLEXIBLE FIRESTOP SEALANT, OR CP 618 FIRESTOP PUTTY STICK APPLIED AT WALL/SLEEVE INTERFACE WHEN STEEL SLEEVE EXTENDS BEYOND ONE OR BOTH SIDES OF WALL.

NOTES: 1. MAXIMUM DIAMETER OF OPENING WITH SLEEVE = 5-1/2".
 2. MAXIMUM DIAMETER OF OPENING WITHOUT SLEEVE = 4".
 3. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1".
 4. A MINIMUM 1/8" SEPARATION SHOULD BE MAINTAINED BETWEEN MI CABLES AND ANY OTHER TYPES OF CABLE.
 5. CABLES TO FILL MAXIMUM 45% OF CROSS-SECTIONAL AREA OF OPENING.
 6. WHEN SCHEDULE 5 STEEL PIPE OR ENT IS USED, OPEN ENDED SLEEVE MAY EXTEND UP TO 18" BEYOND WALL SURFACE. AS AN OPTION, SCHEDULE 5 STEEL PIPE OR ENT SLEEVE MAY EXTEND CONTINUOUSLY BEYOND ONE WALL SURFACE.
 7. WHEN SLEEVE IS CONTINUOUS ON ONE SIDE OF WALL, THE CABLE FILL MAY BE 0% TO 45% AND THE MAXIMUM ANNULAR SPACE IS NOT LIMITED.
 8. (OPTIONAL - NOT SHOWN) MINERAL WOOL (MIN. 4 PCF DENSITY) TIGHTLY PACKED AND RECESSED TO ACCOMMODATE FIRESTOP SEALANT OR PUTTY MAY BE USED AS BACKING MATERIAL.

Hilti Firestop Systems HILTI, Inc. Plano, Texas USA (800) 879-8000
 Scale: 7/8" = 1"
 Date: Apr. 13, 2016
 Drawing No. **WL 3065ad**

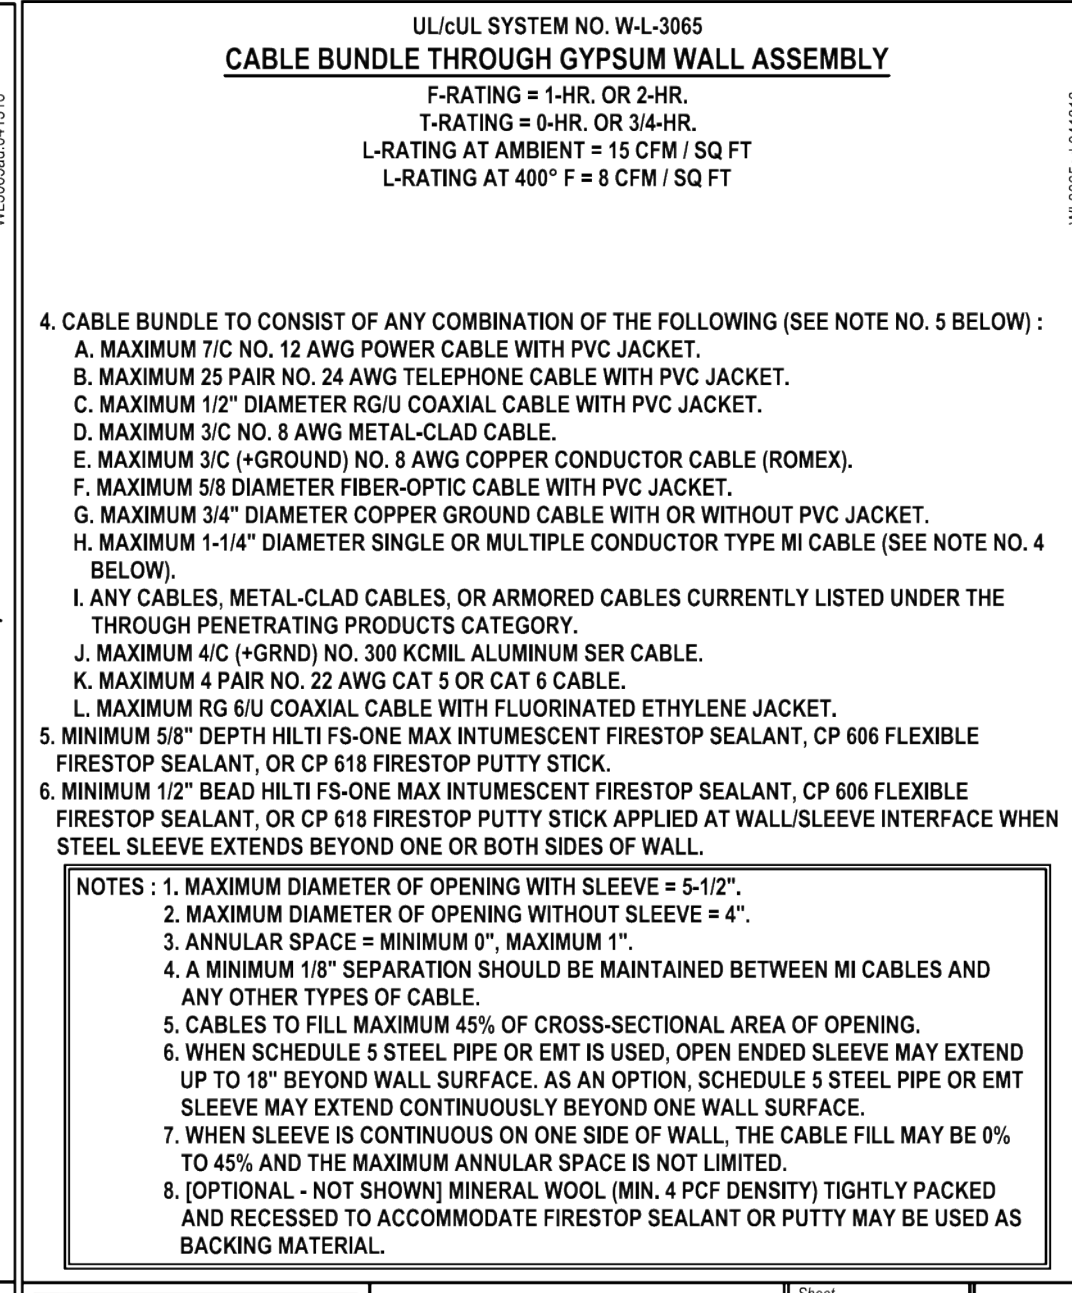

UL SYSTEM NO. F-C-2389
PLASTIC PIPE THROUGH WOOD FLOOR/CEILING ASSEMBLY
 F-RATING = 1-HR.
 T-RATING = 3/4-HR. OR 1-HR.

1. WOOD FLOOR/CEILING ASSEMBLY (UL CLASSIFIED L500 SERIES) (1-HR. FIRE-RATING).
 2. GYPSUM WALL ASSEMBLY TO INCLUDE THE FOLLOWING CONSTRUCTION FEATURES:
 A. WOOD PLATES AND STUDS TO CONSIST OF NOMINAL 2" x 4" OR 2" x 6" LUMBER (SPACED MAXIMUM 16" OC).
 B. MINIMUM 1/2" THICK RATED OR NON-RATED GYPSUM WALLBOARD.
 3. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:
 A. MAXIMUM 3" NOMINAL DIAMETER CPVC PLASTIC PIPE (CELLULAR OR SOLID CORE) FIRESTOP SEALANT, OR CP 618 FIRESTOP PUTTY STICK.
 B. MAXIMUM 3" NOMINAL DIAMETER CPVC PLASTIC PIPE (CELLULAR OR SOLID CORE).
 C. MAXIMUM 3" NOMINAL DIAMETER ABS PLASTIC PIPE (CELLULAR OR SOLID CORE).
 D. MAXIMUM 2" NOMINAL DIAMETER ENT.
 4. MINIMUM 3/4" DEPTH HILTI FS-ONE MAX INTUMESCENT FIRESTOP SEALANT FLUSH WITH TOP SURFACE

DESIGN CRITERIA

BUILDING CODE: 2018 INTERNATIONAL BUILDING CODE (IBC) AS AMENDED BY THE LOCAL JURISDICTION.
VERTICAL LOADS
ROOF LIVE LOAD: 25 PSF (SNOW)
ROOF DEAD LOAD: 25 PSF
RESIDENTIAL FLOOR LIVE LOAD: 40 PSF (REDUCIBLE) : 60 PSF (FOR DECKS)
STAIRWAY LANDING AREAS: 150 PSF (INCLUDING $\rho=1.5$)
FLOOR DEAD LOAD: 30 PSF (INCLUDES 1 1/2" GYP TOPPING)
SNOW DESIGN DATA (ASCE 7-16) WIND DESIGN DATA (ASCE 7-16)
FLAT SNOW LOAD: N/A BASIC WIND SPEED (ASD) V= 85MPH
SNOW EXPOSURE FACTOR, Ce=1.0, ULTIMATE WIND SPEED V= 110MPH
SNOW IMPORTANCE FACTOR, Is=1.0, RISK CATEGORY: II EXPOSURE: B
THERMAL FACTOR, Ct=1.1 IMPORTANCE FACTOR, Iw=1.0
 TOPOGRAPHIC FACTOR, Kzt= 1.0

SEISMIC DESIGN DATA (ASCE7-16)
SEISMIC RESPONSE SYSTEM: WOOD SHEAR WALLS
EQUIVALENT LATERAL FORCE PROCEDURE (ASCE 7-16)
RISK CATEGORY: II SEISMIC IMPORTANCE FACTOR, Ie= 1.0
MAPPED SPECTRAL RESPONSE ACCELERATION: Ss=1.24, S1=0.476
DESIGN SPECTRAL RESPONSE ACCELERATION: Sds=0.831, Sd1=0.476
SITE CLASS: D SEISMIC DESIGN CATEGORY: D
SEISMIC RESPONSE COEFFICIENT: Cs= 0.091
DESIGN BASE SHEAR: 82,321#
SOIL PROPERTIES:
BEARING CAPACITY: 2,000 PSF
LATERAL CAPACITY: 250 PSF/FT

GENERAL REQUIREMENTS

- STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH THE SPECIFICATIONS AND OTHER PROJECT DRAWINGS BY OTHER DISCIPLINES. ALL WORK SHALL CONFORM TO THE REQUIREMENTS OF THE CODES LISTED ABOVE.
- CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND ELEVATIONS RELATING TO EXISTING CONDITIONS BY MAKING FIELD SURVEYS AND MEASUREMENTS PRIOR TO COMMENCING FABRICATION OR CONSTRUCTION.
- THE GENERAL CONTRACTOR SHALL ENSURE THAT ALL CONSTRUCTION METHODS USED WILL NOT CAUSE DAMAGE TO ADJACENT BUILDINGS, UTILITIES, OR OTHER PROPERTY. THIS REQUIREMENT IS PARTICULARLY IMPORTANT DURING FOUNDATION INSTALLATION.
- THE GENERAL CONTRACTOR IS ADVISED TO CONSIDER PERFORMING PHOTOGRAPHIC SURVEYS AND OTHER DOCUMENTATION OF THE CONDITION OF ADJACENT BUILDINGS AND OTHER STRUCTURES BEFORE THE START OF CONSTRUCTION.
- THE GENERAL CONTRACTOR SHALL OBTAIN COPIES OF THE LATEST CONTRACT DOCUMENTS, INCLUDING ALL ADDENDA, AND PROVIDE THE RELEVANT PORTIONS TO ALL SUB-CONTRACTORS AND SUPPLIERS PRIOR TO SUBMITTAL OF SHOP DRAWINGS AND FABRICATION AND ERECTION OF STRUCTURAL MEMBERS.
- THE GENERAL CONTRACTOR SHALL COMPARE AND COORDINATE THE DRAWINGS OF ALL DISCIPLINES AND REPORT ANY DISCREPANCIES BETWEEN THE DRAWINGS TO THE ARCHITECT AND ENGINEER.
- DETAILS LABELED "TYPICAL" SHALL APPLY TO ALL SITUATIONS THAT ARE THE SAME OR SIMILAR TO THOSE SPECIFICALLY DETAILED. SEE DETAIL TITLES FOR APPLICABILITY OF A PARTICULAR DETAIL. TYPICAL DETAILS SHALL APPLY WHETHER OR NOT THEY ARE SPECIFICALLY KEYED AT EACH LOCATION. THE ENGINEER SHALL HAVE FINAL AUTHORITY TO DETERMINE APPLICABILITY OF TYPICAL DETAILS.
- WHERE CONFLICTS EXIST BETWEEN STRUCTURAL DOCUMENTS THE STRICTEST REQUIREMENTS, AS INDICATED BY THE STRUCTURAL ENGINEER SHALL GOVERN.
- THE GENERAL CONTRACTOR SHALL REVIEW AND DETERMINE THAT DIMENSIONS ARE COORDINATED BETWEEN ARCHITECTURAL AND STRUCTURAL DRAWINGS PRIOR TO FABRICATION OR START OF CONSTRUCTION.
- NO STRUCTURAL MEMBER SHALL BE CUT OR NOTCHED OR OTHERWISE REDUCED IN STRENGTH UNLESS APPROVED BY THE STRUCTURAL ENGINEER.
- THE GENERAL CONTRACTOR SHALL COORDINATE ARCHITECTURAL, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR ANCHORED, EMBEDDED OR SUPPORTED ITEMS. NOTIFY THE ARCHITECT / ENGINEER OF ANY DISCREPANCIES.

CONSTRUCTION RESPONSIBILITY

- THE CONTRACT STRUCTURAL DRAWINGS AND SPECIFICATIONS REPRESENT THE COMPLETED STRUCTURE, AND ARE NOT INTENDED TO INDICATE THE METHOD OR MEANS OF CONSTRUCTION. THE CONTRACTOR SHALL SUPERVISE AND DIRECT THE WORK AND SHALL BE SOLELY RESPONSIBLE FOR ALL CONSTRUCTION MEANS, METHODS, PROCEDURES, TECHNIQUES, SEQUENCES, AND FOR JOB SAFETY.
- THE ENGINEER DOES NOT HAVE CONTROL OR CHARGE OF, AND SHALL NOT BE RESPONSIBLE FOR, CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, OR PROCEDURES, FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK, FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, SUBCONTRACTOR, OR ANY OTHER PERSONS PERFORMING ANY OF THE WORK, OR FOR THE FAILURE OF ANY OF THEM TO CARRY OUT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
- PERIODIC SITE OBSERVATION VISITS MAY BE PROVIDED BY THE STRUCTURAL ENGINEER. THE SOLE PURPOSE OF THESE OBSERVATIONS IS TO REVIEW THE GENERAL CONFORMANCE OF THE CONSTRUCTION WITH THE STRUCTURAL CONTRACT DOCUMENTS. THESE LIMITED OBSERVATIONS SHOULD NOT BE CONSTRUED AS CONTINUOUS OR EXHAUSTIVE TO VERIFY THAT ALL CONSTRUCTION IS IN COMPLIANCE WITH THE CONSTRUCTION DOCUMENTS. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR PERFORMING ALL WORK IN COMPLIANCE WITH THE CONSTRUCTION DOCUMENTS.

ABBREVIATIONS

A.F.F.	ABOVE FINISHED FLOOR	N.T.S.	NOT TO SCALE
CLR.	CLEAR	O.C.	ON CENTER
☐	CENTERLINE	PT	PRESSURE TREATED
CONC.	CONCRETE	REINF.	REINFORCEMENT
CONT.	CONTINUOUS	SIM	SIMILAR
C.J.	CONTROL JOINT	SF	SQUARE FEET
E.W.	EACH WAY	S.O.G.	SLAB ON GRADE
GLB	GLULAM BEAM	STL.	STEEL
LBW	LOAD BEARING WALL	T&G	TONGUE AND GROOVE
HD	HOLD DOWN	TYP.	TYPICAL
MFR.	MANUFACTURER	U.N.O.	UNLESS NOTED OTHERWISE
MIN.	MINIMUM	W/	WITH
MTL.	METAL		
N.T.S.	NOT TO SCALE		

DEFERRED SUBMITTALS

THE FOLLOWING IS A LIST OF ITEMS THAT ARE NOT INCLUDED IN THIS PLAN AND SHOULD BE PROVIDED BY THE BUILDER AT TIME OF APPLICATION FOR PERMIT OR AS A DEFERRED SUBMITTAL ITEM:

- ALTERNATIVE I-JOIST/BEAM MANUFACTURER PLANS
- PRE-ENGINEERED TRUSS DESIGNS AND LAYOUTS

SITE WORK

PER KRAZAN & ASSOCIATES, INC. REPORT DATED APRIL 11, 2019, FOUNDATION DESIGN IS BASED ON AN ASSUMED AVERAGE SOIL BEARING OF 2,000 PSF. EXTERIOR FOOTINGS SHALL BEAR 18" & INTERIOR FOOTINGS SHALL BEAR 12" (MINIMUM) BELOW FINISHED GRADE. ALL FOOTINGS TO BEAR ON FIRM UNDISTURBED EARTH BELOW ORGANIC SURFACE SOILS OR ON STRUCTURAL FILL PER THE GEOTECHS RECOMMENDATIONS.

CONCRETE

ITEM	DESIGN f'c (PSI)	MAX. W/C RATIO	MAX. AGGREGATE SIZE	MIN. CEMENT (SACKS/YARD)
FOUNDATIONS	2,500 @28 DAYS	0.45	3/4"	
STEM WALLS	3,000 @28 DAYS	0.45	3/4"	
SLAB ON GRADE	3,000 @28 DAYS	0.45	3/4"	

- REINFORCING STEEL SHALL BE ASTM A615 GRADE 40 FOR #4 BARS AND SMALLER AND GRADE 60 FOR #5 BARS AND LARGER.
- MINIMUM SPLICE LENGTHS SHALL BE: 24" FOR #4, 30" FOR #5, 42" FOR #6
- CONCRETE COVER SHALL BE: 3" CAST AGAINST EARTH, 2" EXPOSED TO EARTH/WEATHER, 3/4" NOT EXPOSED TO EARTH/WEATHER.
- CORNER BARS ARE REQUIRED FOR ALL HORIZONTAL BARS IN FOOTINGS AND WALLS.
- ALL CONCRETE HAS BEEN DESIGNED FOR 2,500 PSI CONCRETE SO NO SPECIAL INSPECTION IS REQUIRED.

FRAMING


- ALL NAILING TO COMPLY WITH REQUIREMENTS OF IBC 2303.6 AND FASTENED PER TABLE 2304.10.1.
- ALL WOOD IN CONTACT WITH CONCRETE TO BE PRESSURE TREATED. FIELD CUT ENDS, NOTCHES, AND DRILLED HOLES OF PRESSURE TREATED LUMBER SHALL BE RETREATED IN THE FIELD IN ACCORDANCE WITH AWPA M4.
- FASTENERS FOR PRESSURE PRESERVATIVE AND FIRE RETARDANT TREATED WOOD SHALL BE OF HOT-DIPPED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE OR COPPER.
- MAINTAIN 8" MINIMUM CLEARANCE BETWEEN WOOD AND EARTH.
- MAINTAIN 12" MINIMUM CLEARANCE BETWEEN FLOOR BEAMS AND EARTH.
- MAINTAIN 18" MINIMUM CLEARANCE BETWEEN FLOOR JOISTS AND EARTH.

LUMBER GRADES

FRAMING LUMBER SHALL COMPLY WITH THE LATEST EDITION OF THE GRADING RULES OF THE WESTERN PRODUCTS ASSOCIATION OR THE WEST COAST LUMBER INSPECTION BUREAU. ALL SAWN LUMBER SHALL BE STAMPED WITH THE GRADE MARK OF AN APPROVED LUMBER GRADING AGENCY AND SHALL HAVE THE FOLLOWING UNADJUSTED DESIGN MINIMUM PROPERTIES:

JOISTS:	WOOD TYPE:
2X4	HF #2 - Fb=850 PSI, FV=75 PSI, Fc=1300 PSI, E=1200000 PSI
2X6 OR LARGER	HF #2 - Fb=850 PSI, Fv=75 PSI, Fc=1300 PSI, E=1200000 PSI
BEAMS:	WOOD TYPE:
4X	DF-L#2 - Fb=900 PSI, FV=95 PSI, Fc=1350 PSI, E=1600000 PSI
6X OR LARGER	DF-L #2 - Fb=875 PSI, Fv=85 PSI, Fc=600 PSI, E=1300000 PSI
STUDS:	WOOD TYPE:
2X4	HF #2 - Fb=850 PSI, FV=75 PSI, Fc=1300 PSI, E=1200000 PSI
2X6 OR LARGER	HF #2 - Fb=850 PSI, Fv=75 PSI, Fc=1300 PSI, E=1200000 PSI
POSTS:	WOOD TYPE:
4X4	HF #2 - Fb=900 PSI, FV=95 PSI, Fc=1350 PSI, E=1600000 PSI
4X6 OR LARGER	HF #2 - FB=900 PSI, FV=95 PSI, FC=1350 PSI, E=1600000 PSI
6X6 OR LARGER	DF-L #1 - FB=700 PSI, FV=85 PSI, FC=475 PSI, E=1300000 PSI
6X6 OR LARGER	DF-L #2 - FB=700 PSI, FV=85 PSI, FC=475 PSI, E=1300000 PSI

SYMBOL LEGEND

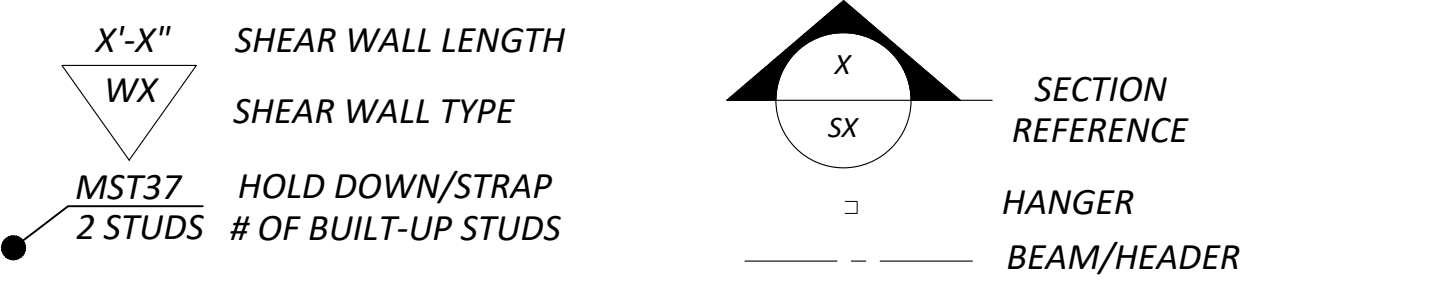

FASTENERS

ALL NAILS SPECIFIED ON THIS PLAN SHALL BE COMMON OR GALVANIZED BOX (UNLESS NOTED OTHERWISE) OF THE DIAMETER AND LENGTH LISTED BELOW OR AS PER APPENDIX L OF THE NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION (NDS). ALL FASTENERS PLACE IN PRESSURE TREATED OR FIRE TREATED LUMBER/SHEATHING SHALL BE GALVANIZED.

- 8D COMMON (0.131" DIA., 2-1/2" LENGTH)
- 8D BOX (0.113" DIA., 2-1/2" LENGTH)
- 10D COMMON (0.148" DIA., 3" LENGTH)
- 10D BOX (0.128" DIA., 3" LENGTH)
- 16D COMMON (0.162" DIA., 3-1/2" LENGTH)
- 16D SINKER (0.148" DIA., 3-1/4" LENGTH)
- 5D COOLER (0.086" DIA., 1-5/8" LENGTH)
- 6D COOLER (0.092" DIA., 1-7/8" LENGTH)

SHEATHING

TYPICAL ROOF SHEATHING SHALL BE APA RATED 7/16" SHEATHING WITH A SPAN INDEX OF 24/16. FLOOR SHEATHING SHALL BE APA RATED 3/4" T&G SHEATHING WITH A SPAN INDEX OF 48/24 UNLESS NOTED OTHERWISE. STAGGER END LAPS AT ROOF AND FLOOR SHEATHING. WALL SHEATHING SHALL BE APA RATED 7/16" SHEATHING WITH A SPAN INDEX OF 24/0 UNLESS NOTED OTHERWISE.

GLULAM BEAMS (GLB)

GLULAM BEAMS SHALL BE 24F-V4 FOR SINGLE SPANS AND 24F-V8 FOR CONTINUOUS OR CANTILEVER SPANS WITH THE FOLLOWING MINIMUM PROPERTIES:
 Fb=2400 PSI, Fv=240 PSI, Fc=650 PSI (PERPENDICULAR), E=1,800,000 PSI.

ENGINEERED WOOD BEAMS AND I-JOIST

CONTRACTOR SHALL SUBMIT SHOP DRAWINGS AND SPECIFICATIONS FOR APPROVAL BY BUILDING OFFICIAL. DESIGN, FABRICATION AND ERECTION IN ACCORDANCE WITH THE LATEST ICC EVALUATION REPORT.
 BEAMS DESIGNATED AS "PSL" SHALL HAVE THE MINIMUM PROPERTIES:
 Fb=2900 PSI, Fv=290 PSI, Fc=750 PSI (PERPENDICULAR), E=2,000,000 PSI.
 BEAMS DESIGNATED AS "LVL" SHALL HAVE THE MINIMUM PROPERTIES:
 Fb=2600 PSI, Fv=285 PSI, Fc=750 PSI (PERPENDICULAR), E=1,900,000 PSI.
 BEAMS DESIGNATED AS "LSL" SHALL HAVE THE MINIMUM PROPERTIES:
 Fb=1700 PSI, Fv=400 PSI, Fc=680 PSI (PERPENDICULAR), E=1,300,000 PSI.

PRE-ENGINEERED ROOF TRUSSES

PRE-ENGINEERED ROOF TRUSSES IS A DEFERRED SUBMITTAL ITEM AND IS TO BE DESIGNED, FABRICATED AND INSTALLED PER THE LATEST TRUSS PLATE INSTITUTE STANDARDS, AND IBC SECTION 2303.4. PREFABRICATED ITEMS TO BE DESIGNED BY A LICENSED PROFESSIONAL ENGINEER. THE FABRICATOR SHALL PROVIDE ALL CONNECTION DESIGN, DETAILS AND INSTALLATION INSTRUCTIONS, WHICH SHALL BE AVAILABLE ON SITE FOR INSPECTION. WHERE TRUSSES ARE NOT PROVIDED TO COMPLETE THE ROOF SYSTEM, OVERFRAMING MEMBERS AND CONNECTIONS SHALL BE PROVIDED. OVERFRAMING DETAILS SHALL BE INCLUDED IN THE TRUSS SHOP DRAWINGS IN ORDER TO PROVIDE LOADING CONDITIONS CONSISTENT WITH THE MODELING OF THE TRUSSES. THE OVERFRAMING AND RELATED DETAILS SHALL BE DESIGNED BY THE TRUSS ENGINEER. TRUSSES (OR DRAG TRUSSES) ALIGNING WITH SHEAR WALLS SHALL BE SPECIAL TRUSSES THAT HAS BEEN DESIGNED TO TRANSFER THE SPECIFIC WIND AND SEISMIC LOADS SHOWN ON THE PLANS. THE TRUSS SHALL BE DESIGNED TO TRANSFER THE LOAD BETWEEN THE ROOF SHEATHING AND THE SHEAR WALL BELOW. THE TRUSS SHALL BE DESIGNED TO TRANSFER A MINIMUM OF 100 PLF ALONG THE LENGTH OF THE TRUSS. TEMPORARY AND PERMANENT BRACING REQUIRED FOR THE STABILITY OF THE TRUSS ELEMENTS UNDER GRAVITY LOADS AND IN-PLANE WIND OR SEISMIC LOADS SHALL BE DESIGNED BY THE TRUSS ENGINEER WHERE THE TOP CHORD IS NOT DIRECTLY ATTACHED TO THE ROOF SHEATHING. THE TRUSS ENGINEER SHALL DESIGN AND SHOW THE PLACEMENT OF ALL REQUIRED TOP CHORD BRACING AND CONNECTIONS ON THE TRUSS SHOP DRAWINGS. ANY BRACING LOADS TRANSFERRED TO THE MAIN BUILDING SYSTEM SHALL BE IDENTIFIED AND SUBMITTED TO THE ENGINEER OF RECORD FOR REVIEW. DESIGN CALCULATIONS AND SHOP DRAWINGS SHALL BE SUBMITTED FOR REVIEW BY THE ENGINEER OF RECORD PRIOR TO SUBMITTING TO THE BUILDING OFFICIAL FOR APPROVAL. ROOF TRUSS TOP CORD MUST BE HF#2 OR BETTER.


SPECIAL INSPECTIONS

SOILS (PER IBC 1705.6):
 CONTINUOUS SPECIAL INSPECTION SHALL BE REQUIRED FOR MATERIAL, DENSITIES AND LIFT THICKNESS DURING PLACEMENT AND COMPACTION OF COMPACTED STRUCTURAL FILL AND PERIODIC SPECIAL INSPECTION IS REQUIRED TO VERIFY SHALLOW FOUNDATIONS BEARING MATERIAL MEETS DESIGNED BEARING CAPACITY, VERIFYING EXCAVATION ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL, PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIAL AND TO INSPECT SUBGRADE MATERIAL PRIOR TO COMPACTED FILL PLACEMENT TO VERIFY THE SITE HAS BEEN PREPARED PROPERLY.

WOOD CONSTRUCTION (PER IBC 1705.5) AND WIND RESISTANCE (PER IBC 1705.11):
 PERIODIC SPECIAL INSPECTION IS REQUIRED TO VERIFY NAILING, BOLTING, ANCHORING AND OTHER FASTENING OF ELEMENTS OF SHEAR WALLS WITH NAIL SPACING 4" AND LESS, DRAG STRUTS, BRACES AND HOLD DOWNS.

POST-INSTALLED ANCHORS

- POST-INSTALLED ANCHORS SHALL ONLY BE USED WHERE SPECIFIED ON THE DRAWINGS. CONTRACTOR SHALL OBTAIN APPROVAL FROM ENGINEER OF RECORD (EOR) PRIOR TO USING POST-INSTALLED ANCHORS FOR MISSINGS OR MISPLACED ANCHORS.
- CARE SHALL BE GIVEN TO AVOID CONFLICTS WITH EXISTING REINFORCING WHEN DRILLING HOLES. HOLES SHALL BE DRILLED AND CLEANED PER THE MANUFACTURER'S INSTRUCTIONS. ANCHORS SHALL BE INSTALLED PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AT NOT LESS THAN MINIMUM EDGE DISTANCES AND/OR SPACING INDICATED IN THE MANUFACTURER'S LITERATURE.
- SPECIAL INSPECTION SHALL BE PROVIDED FOR ALL ADHESIVE AND MECHANICAL ANCHOR INSTALLATIONS AS REQUIRED BY THE EOR. INDEPENDENT ON-SITE PROOF LOAD TESTING SHALL BE PERFORMED AS REQUIRED BY THE EOR. CONTACT EOR FOR NUMBER OF ANCHORS REQUIRED TO BE TESTED AND REQUIRED PROOF LOAD MAGNITUDE.
- UNLESS NOTED OTHERWISE ON DOCUMENTS, ACCEPTABLE PRODUCTS SHALL BE AS LISTED BELOW:
 - MECHANICAL ANCHORS INTO CONCRETE:
 - USE THE FOLLOWING (UNO):
 - SIMPSON TITEN HD (ICC-ES AC193 AND ACI 355.2) FOR CRACKED & UNCRACKED CONCRETE PER (ICC-ES ESR-2713)
 - HILTI KWIK BOLT TZ CARBON AND STAINLESS STEEL ANCHORS (ICC-ES ESR1917)
 - RED HEAD TRUBOLT + WEDGE ANCHORS (ICC-ES ESR2427)
 - SIMPSON STRONG-TIE STRONG-BOLT (STB) (ICC-ES ESR1771)(FL8668)
 - USE THE FOLLOWING ONLY WHERE SPECIFICALLY CALLED OUT ON THE DOCUMENTS:
 - HILTI HDA (ICC-ES ESR1546)
 - HILTI HSL-3 ANCHOR (ICC-ES ESR1545)
 - SIMPSON STRONG-TIE TITEN HD (THD) (ICC-ES ESR2713)(FL2304)
 - MECHANICAL ANCHORS INTO MASONRY LINTELS OR GROUT FILLED CELLS:
 - USE THE FOLLOWING (UNO):
 - SIMPSON TITEN HD (ICC-AC AC106) FOR MASONRY PER (ICC-ES ESR-1056)
 - HILTI KWIK BOLT 3 MASONRY ANCHORS (ICC-ES ESR1385)
 - SIMPSON STRONG-TIE WEDGE-ALL ANCHOR(WA) (IC80-ES ER-3631) (FL5415)
 - USE THE FOLLOWING ONLY WHERE SPECIFICALLY CALLED OUT ON THE DOCUMENTS:
 - HILTI HUS-H SCREW ANCHOR (ICC-ES ESR2369)
 - SIMPSON STRONG-TIE TITEN HD (THD) (ICC-ES ESR1056)(FL2304)
- ADHESIVE ANCHORS INTO CONCRETE:
 - USE THE FOLLOWING (UNO):
 - HILTI HIT-RE 500-SD ADHESIVE (ICC-ES ESR2322)
 - RED HEAD EPCON G5 ADHESIVE (ICC-ES ESR1137)(FL6582)
 - SIMPSON STRONG-TIE SET-XP EPOXY-TIE ADHESIVE (SETXP) (ICC-ES ESR2508)
 - USE THE FOLLOWING ONLY WHERE SPECIFICALLY CALLED OUT ON THE DOCUMENTS:
 - HILTI HIT HY 150 MAX ADHESIVE (ICC-ES ESR2262)
- ADHESIVE ANCHORS INTO MASONRY LINTELS OR GROUT FILLED CELLS:
 - USE THE FOLLOWING (UNO):
 - HILTI HIT HY-150 MAX ADHESIVE (ICC-ES ESR1967)
 - SIMPSON STRONG-TIE SET EPOXY-TIE ADHESIVE (SET) (ICC-ES ESR1772)(FL5550)



PIERUCCIONI E&C, LLC
 CHON PIERUCCIONI, PE
 STEIN, BENNETT ST.
 TACOMA, WA 98402

RELEASE OF DOCUMENTS
 THIS DOCUMENT AND THE DESIGN AND CONSTRUCTION THEREOF ARE THE PROPERTY OF PIERUCCIONI E&C, LLC AND ARE NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM.

EAST TOWN CROSSING
 BUILDING "F"
 PIONEER & SHAW PUYALLUP WA

REVISIONS

NO.	DATE	DESCRIPTION
01	---	---

REVISIONS

DRAWN BY: CP
 CHECKED BY: CP
 DATE: 2024.02.28
 TITLE: STRUCTURAL NOTES
 PROJECT #: ---
 SHEET:



PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
378 N. BENNETT ST.
TACOMA, WA 98402

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE DESIGN AND CONSTRUCTION DETAILS ARE THE PROPERTY OF PIERUCCIONI E&C, LLC AND ARE NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF PIERUCCIONI E&C, LLC.

EAST TOWN CROSSING
BUILDING "F"
PIONEER & SHAW PUYALLUP WA

REVISIONS

01 ---

REVISIONS

DRAWN BY: CP

CHECKED BY: CP


DATE: 2024.02.28

TITLE: FOUNDATION PLAN

PROJECT #: ---

SHEET:

S3.1

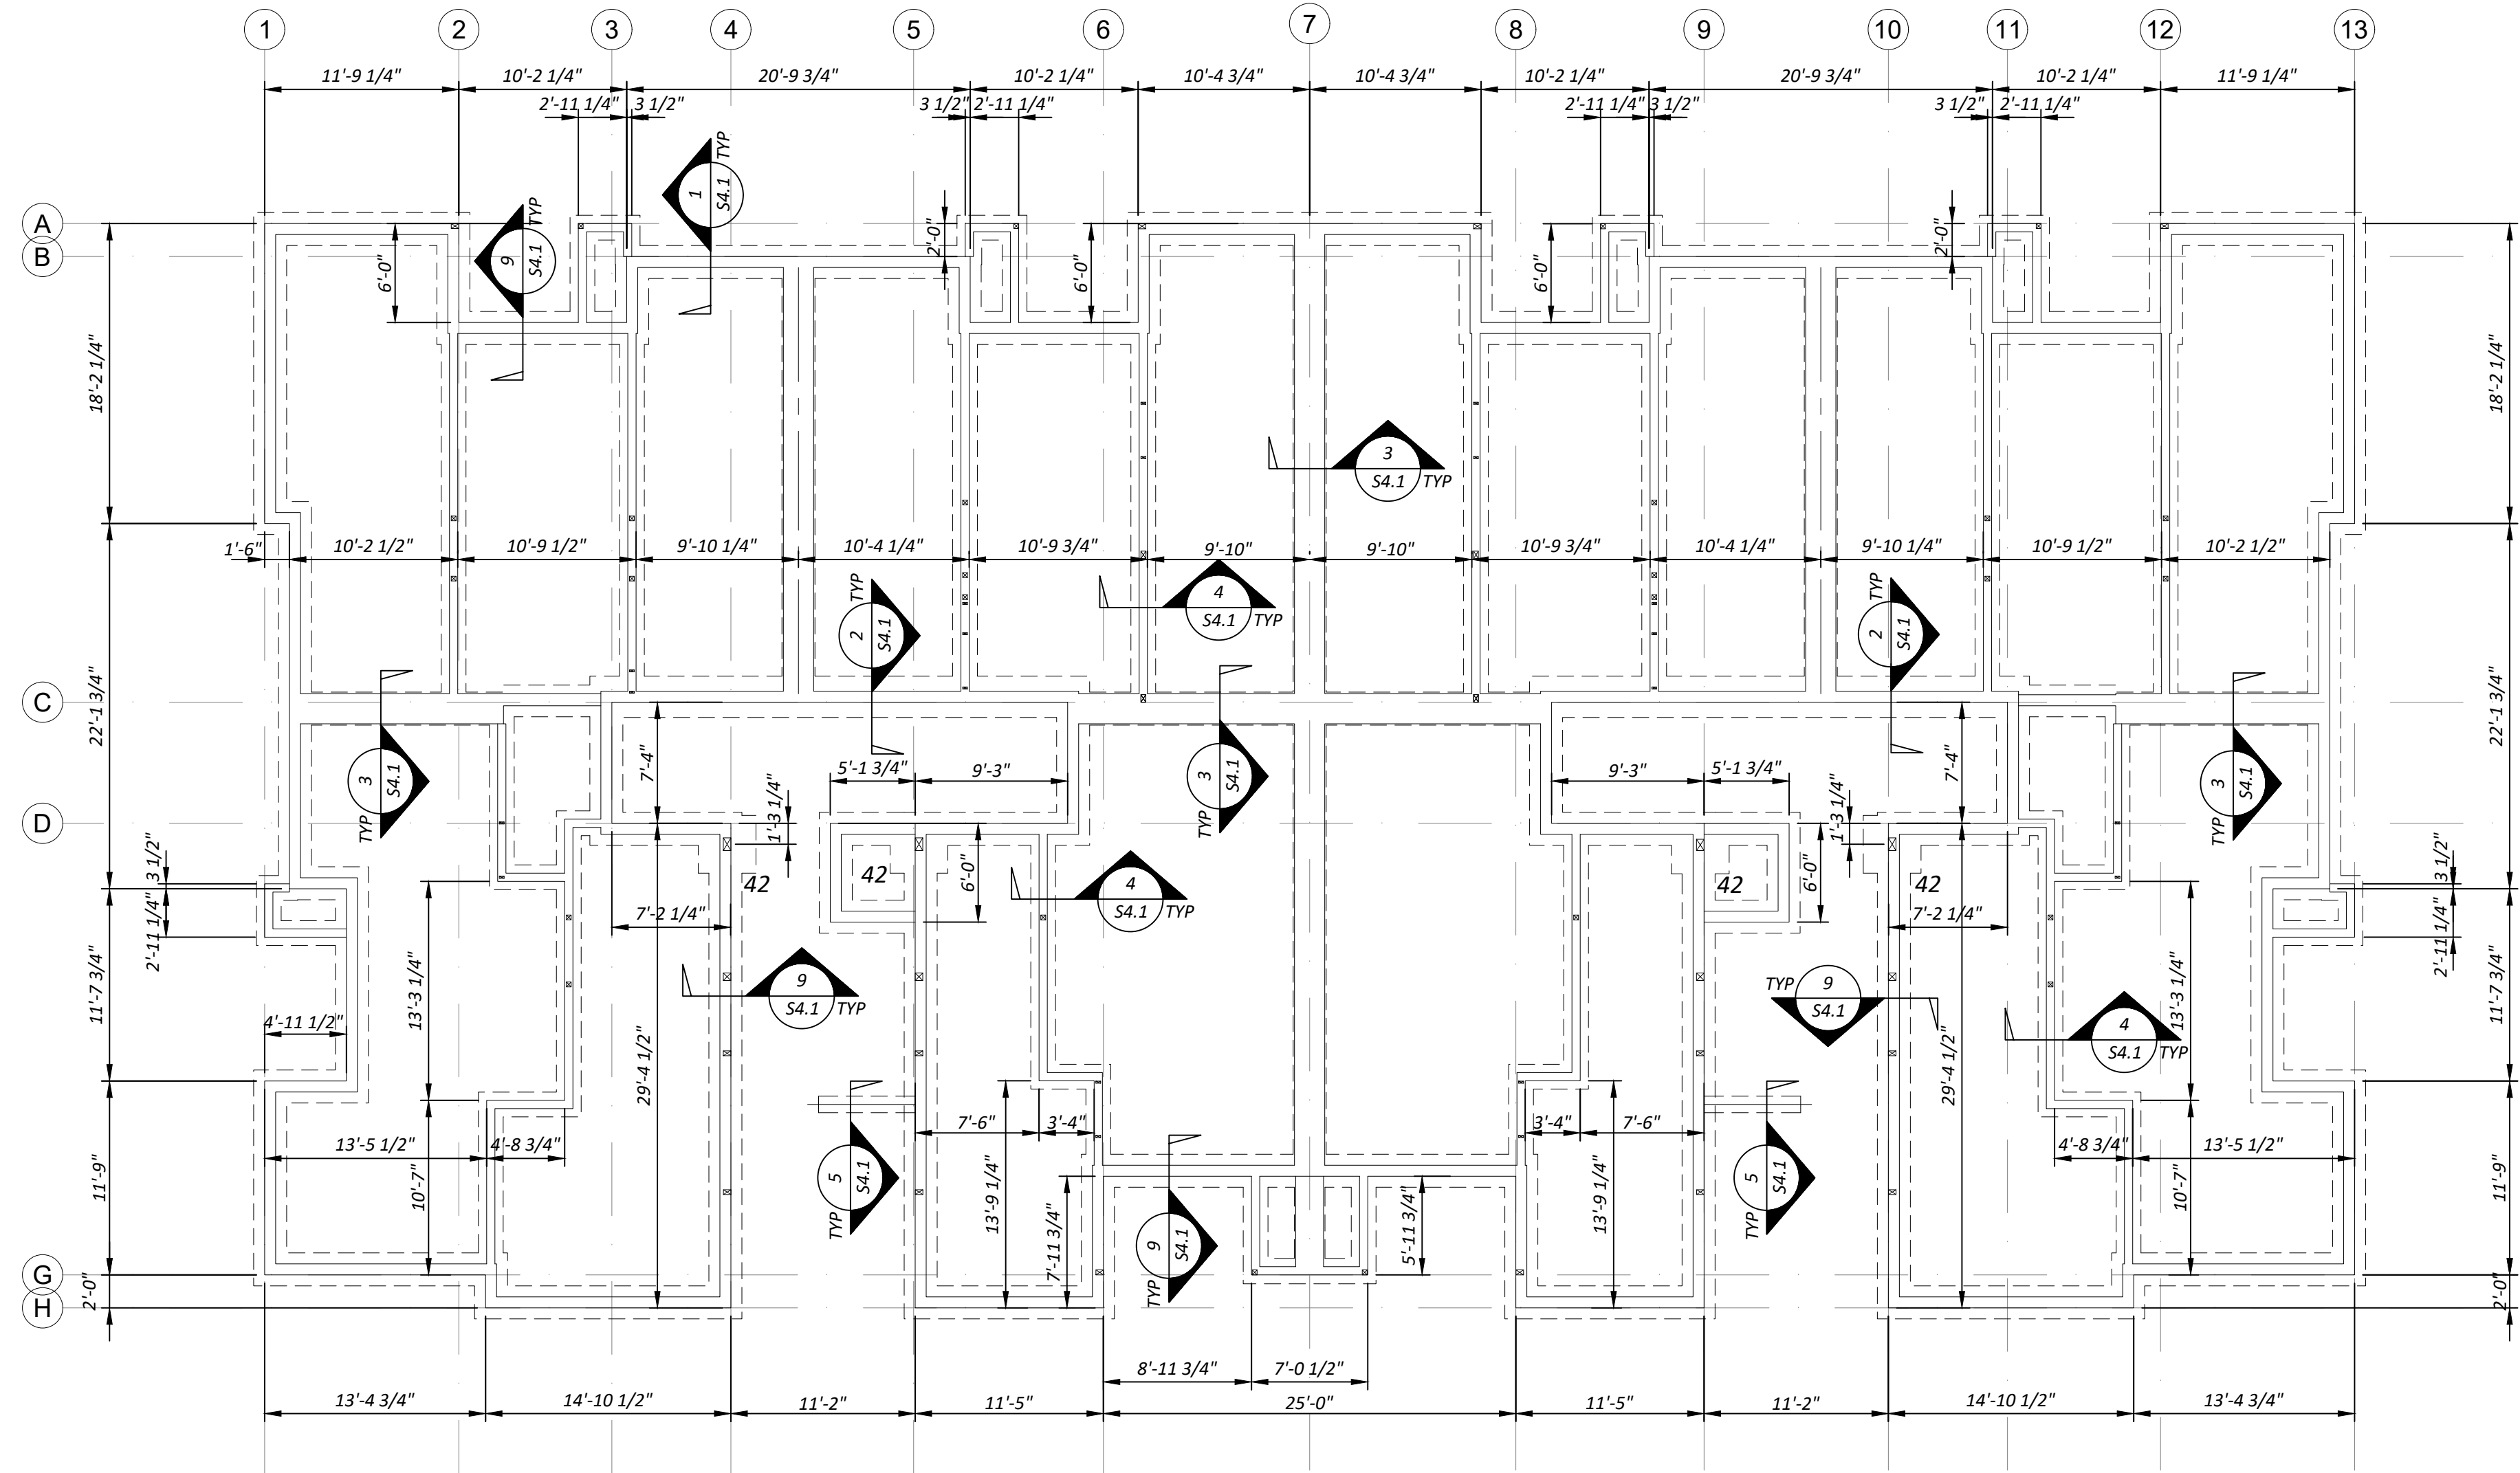

FOUNDATION PLAN
1/8" = 1'-0"

FOOTING SCHEDULE

42 POST ON 42" SQUARE X 8" THICK CONC. FOOTING W/ 5-#4 BARS E.W.


NOTES:

1. USE MIN. 6" WIDE POST BELOW BEAM SPLICES
2. USE 4X4 POST BELOW 4X BEAMS, U.N.O.
3. USE 6X6 POST BELOW 6X BEAMS, U.N.O.
4. PT POST SHALL BE USED IN EXTERIOR CONDITIONS

NOTES:

1. PER KRAZAN & ASSOCIATES, INC. REPORT DATED APRIL 11, 2019, FOUNDATION DESIGN IS BASED ON AN ASSUMED AVERAGE SOIL BEARING OF 2,000 PSF. EXTERIOR FOOTINGS SHALL BEAR 18" & INTERIOR FOOTINGS SHALL BEAR 12" (MINIMUM) BELOW FINISHED GRADE. ALL FOOTINGS TO BEAR ON FIRM UNDISTURBED EARTH BELOW ORGANIC SURFACE SOILS OR ON STRUCTURAL FILL PER THE GEOTECHS RECOMMENDATIONS. IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY THAT THE SITE SOILS PROVIDE THIS MINIMUM BEARING CAPACITY.
2. EXTERIOR FOOTINGS TO BE A MINIMUM OF 18" BELOW FINISHED GRADE BEARING ON NATIVE UNDISTURBED SOIL OR STRUCTURAL FILL.
3. INTERNAL FOOTINGS TO BE A MINIMUM OF 12" BELOW FINISHED GRADE BEARING ON NATIVE UNDISTURBED SOIL OR STRUCTURAL FILL.
4. INTERIOR S.O.G. SHALL BE 4" THICK SLAB ON GRADE OVER INSULATION (PER ARCH.), OVER VAPOR BARRIER (PER ARCH.) OVER 4" COMPACTED SAND OR GRAVEL. SLAB SHALL BE REINFORCED WITH 6X6 W2.9XW2.9 WELDED WIRE, #3 BARS @ 24" O.C., OR HELIX FABRIC (5# PER CUBIC YARD).
5. EXTERIOR SLAB SHALL BE 4" THICK SLAB ON GRADE SLOPED AT 1% AWAY FROM BUILDING..
6. CONTROL JOISTS SHALL BE 15' O.C. MAX.
7. SEE SHEAR WALL PLAN ON SHEET S4.6 FOR HOLD DOWN AND ANCHOR BOLT LOCATIONS NOT SHOWN HERE.

SPECIAL INSPECTION IS
REQUIRED FOR
FOUNDATION SOIL BEARING

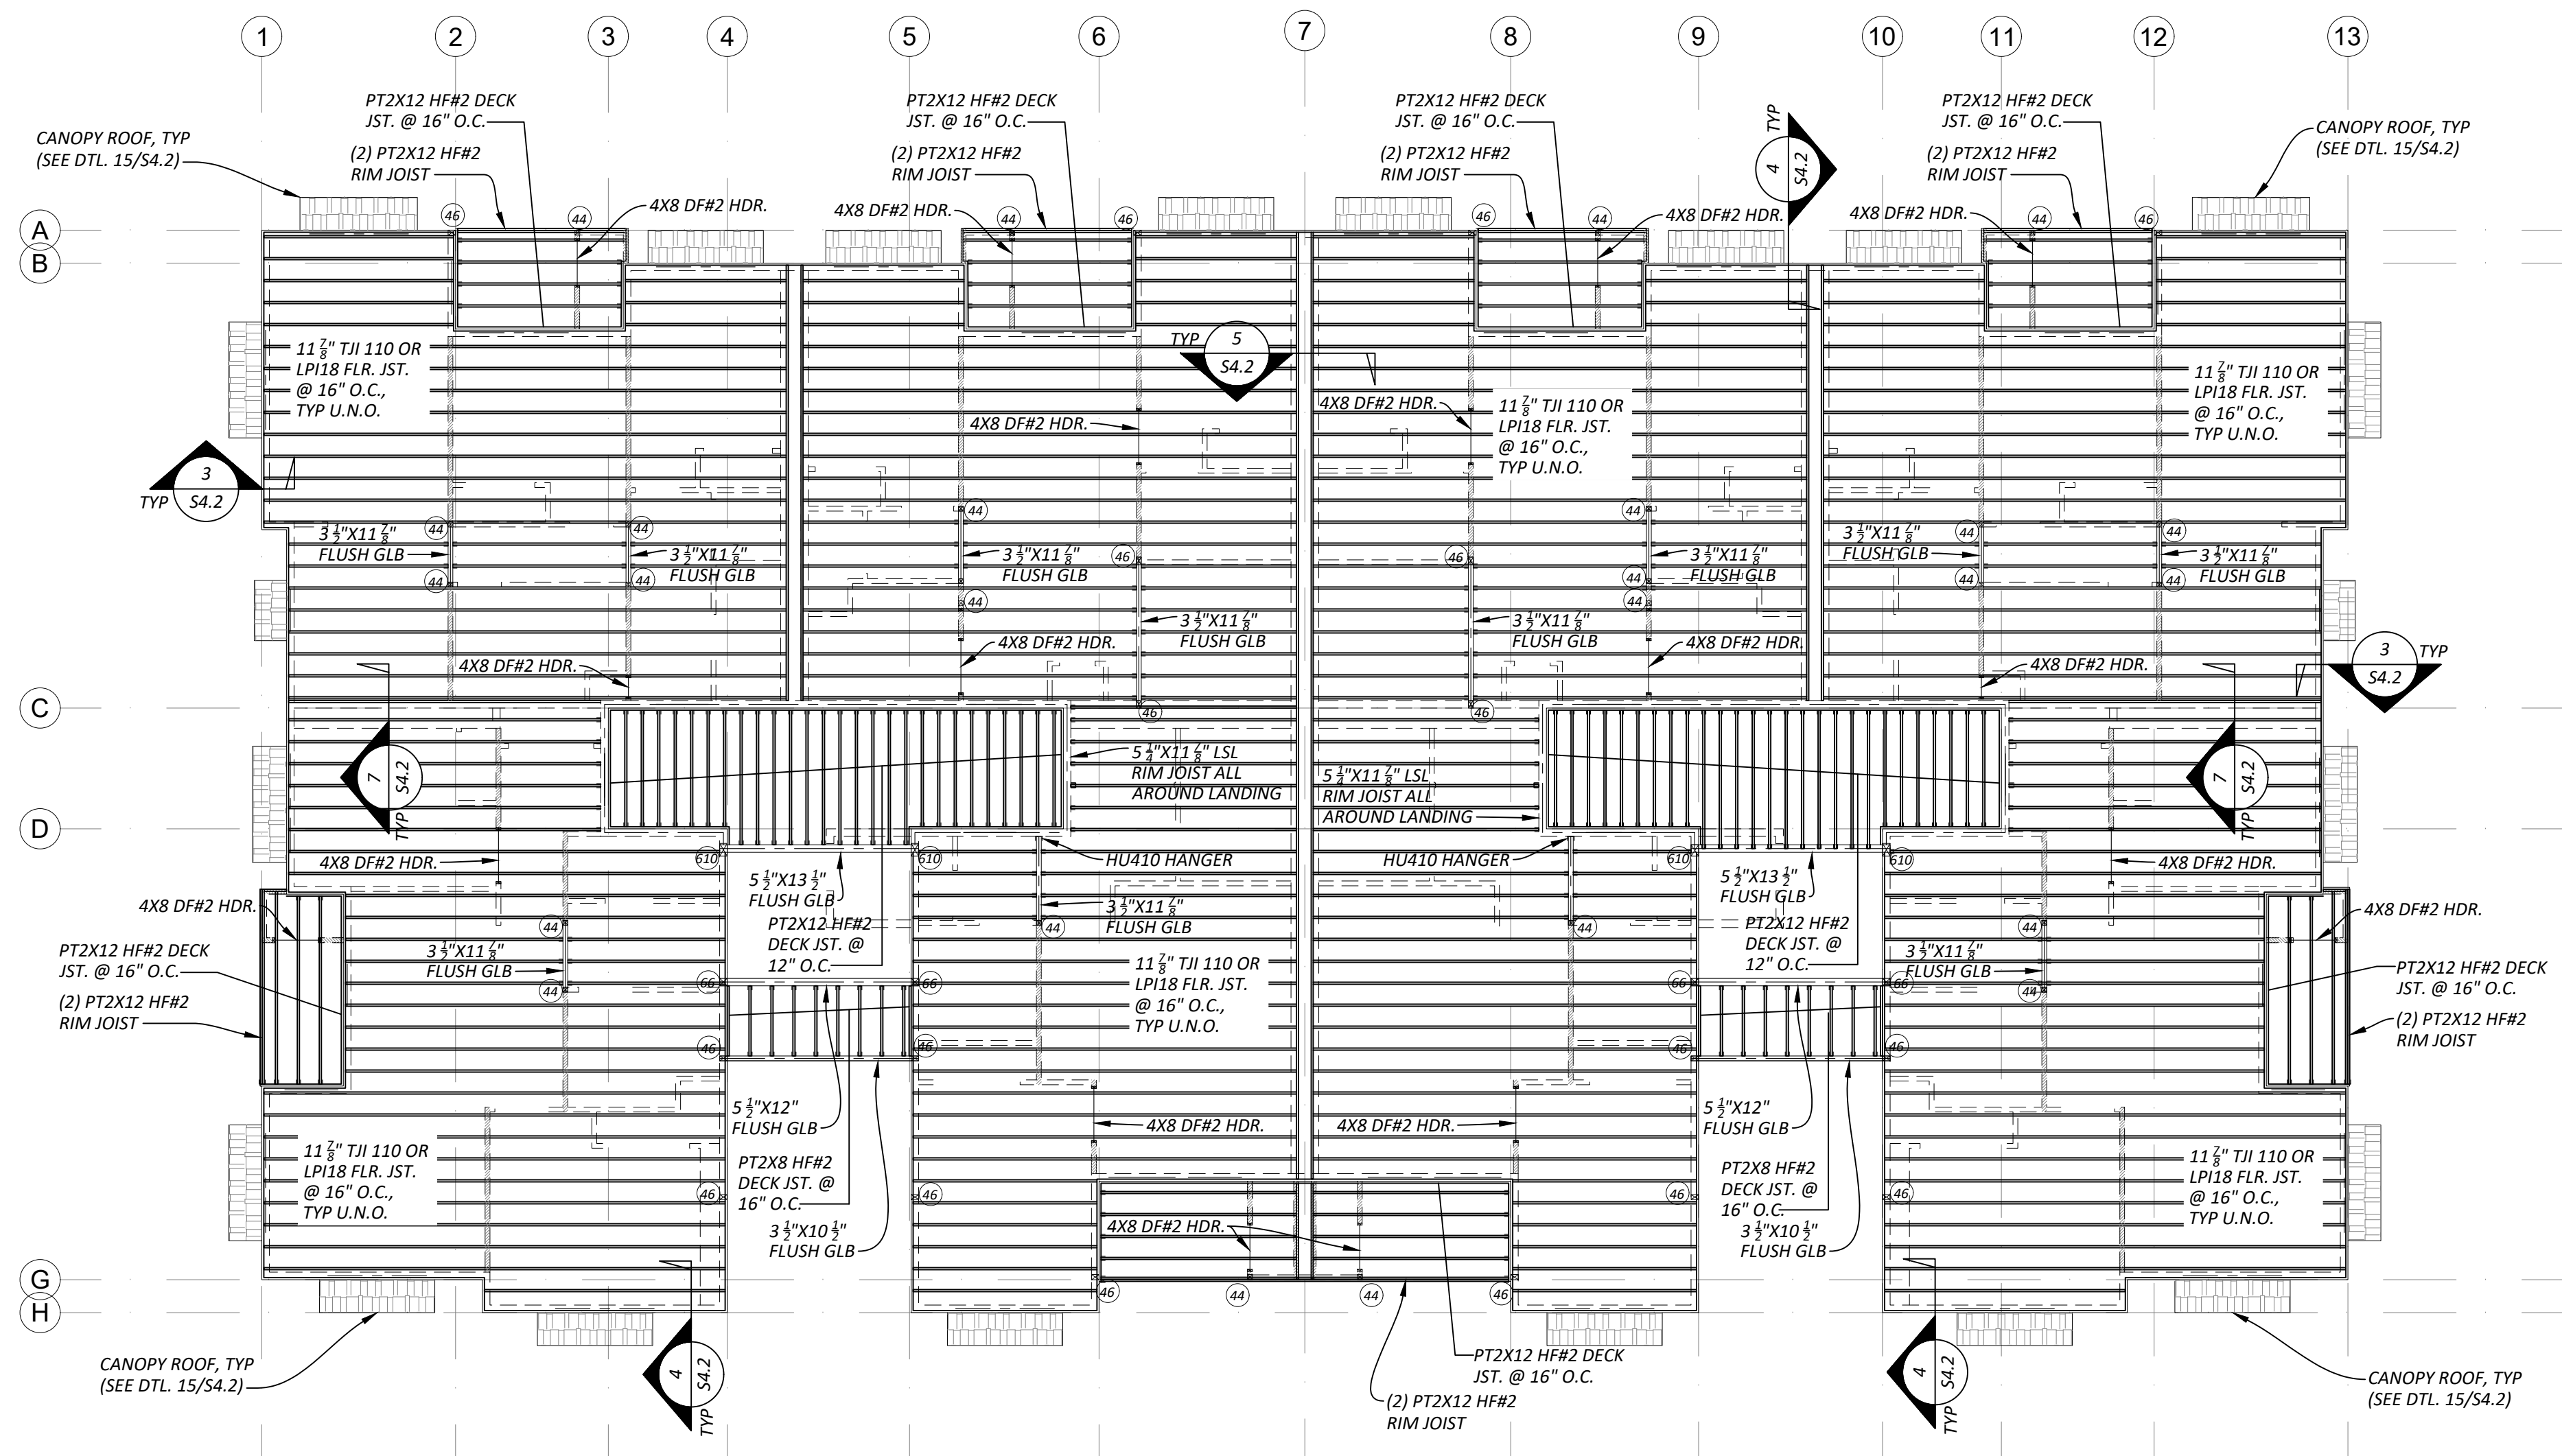

POST SCHEDULE

POST NUMBER	POST TYPE	ALTERNATIVE BUILT-UP POST
44	4X4 DF#2	(3) 2X4 DF#2 STUDS
46	4X6 DF#2	(3) 2X6 DF#2 STUDS
48	4X8 DF#2	(5) 2X4 DF#2 STUDS
64	4X6 DF#2	(4) 2X4 DF#2 STUDS
66	6X6 DF#2	(4) 2X6 DF#2 STUDS
68	6X8 DF#2	(5) 2X6 DF#2 STUDS
610	6X10 DF#2	---

LEVEL 2 FRAMING PLAN
1/8" = 1'-0"

SEE SHEAR WALL PLANS FOR HOLD DOWN LOCATIONS THAT REQUIRE DF#2 STUDS


- NOTES:**
- USE MIN. 6" WIDE POST BELOW BEAM SPLICES
 - USE 4X4 DF#2 POST BELOW 4X BEAMS, U.N.O.
 - USE 6X6 DF#2 POST BELOW 6X BEAMS, U.N.O.
- NOTES:**
- ALL COLUMNS NOT SPECIFIED OR OTHERWISE NOTED ON THE PLANS ARE LAMINATED TOGETHER PER "TYPICAL BUILT-UP COLUMN DETAIL" ON SHEET S4.2. SOLID WOOD COLUMNS MAY BE SUBSTITUTED FOR BUILT-UP COLUMNS BY PROVIDING AN EQUIVALENT CROSS SECTIONAL AREA.
 - ALL BEAMS SHALL HAVE A MINIMUM OF 3X BUILT-UP COLUMN WITH CONTINUOUS LOAD PATH TO FOUNDATION.
 - ALL HEADERS UNLESS SPECIFIED ON THE PLANS ARE TO BE 4X10 DF-L #2 WITH AT LEAST ONE CRIPPLE AND ONE STUD FOR EACH END FOR OPENINGS LESS THAN OR EQUAL TO 5'-0" WIDE AND TWO CRIPPLES AND ON KING STUD FOR ALL OTHERS.
 - ALL TJI FLOOR JOIST HUNG FROM FLUSH BEAMS SHALL BE HUNG WITH IUS SERIES HANGERS.
 - ALL RIM JOIST SHALL BE 1 1/2" X 11 1/2" LSL U.N.O. SEE SHEAR WALL TABLE TO AREAS REQUIRING THICKER RIM JOIST.
 - FLOOR SHEATHING SHALL BE 3/4" T&G (48/24) GLUED AND NAILED WITH 10d @ 4" O.C. ALONG PANEL EDGES AND 12" O.C. FIELD. STAGGER END LAPS. NAILS SHALL EMBED 1 1/2" MINIMUM INTO FLOOR JOIST. THIS LEVEL REQUIRES BLOCKING AT ALL SHEATHING PANEL EDGES.
 - SHORT MID LANDING STAIR STRINGERS SHALL BE PT4X12 HF#2.
 - LONG GROUND FLOOR STAIR STRINGERS SHALL BE PT3 1/2" X 12" GLB.
 - EXTERIOR WALLS TO BE 2X6 AT 16" O.C., U.N.O.
 - INTERIOR PARTITIONS TO BE 2X4 AT 16" O.C. (2X6 @ PLUMBING WALLS OR PER ARCH.) U.N.O.
 - FLOOR JOISTS AND BEAMS OF EQUAL OR BETTER CAPACITY MAY BE SUBSTITUTED FOR THOSE SHOWN ON THIS PLAN, "EQUAL" IS DEFINED AS HAVING MOMENT CAPACITY, SHEAR CAPACITY, AND STIFFNESS WITHIN 3% OF THE SPECIFIED JOISTS OR BEAMS.

REVISIONS

NO.	DESCRIPTION
01	---

REVISIONS

DRAWN BY:	CP
CHECKED BY:	CP
DATE:	2024.02.28
TITLE:	FRAMING PLAN
PROJECT #:	---
SHEET:	---

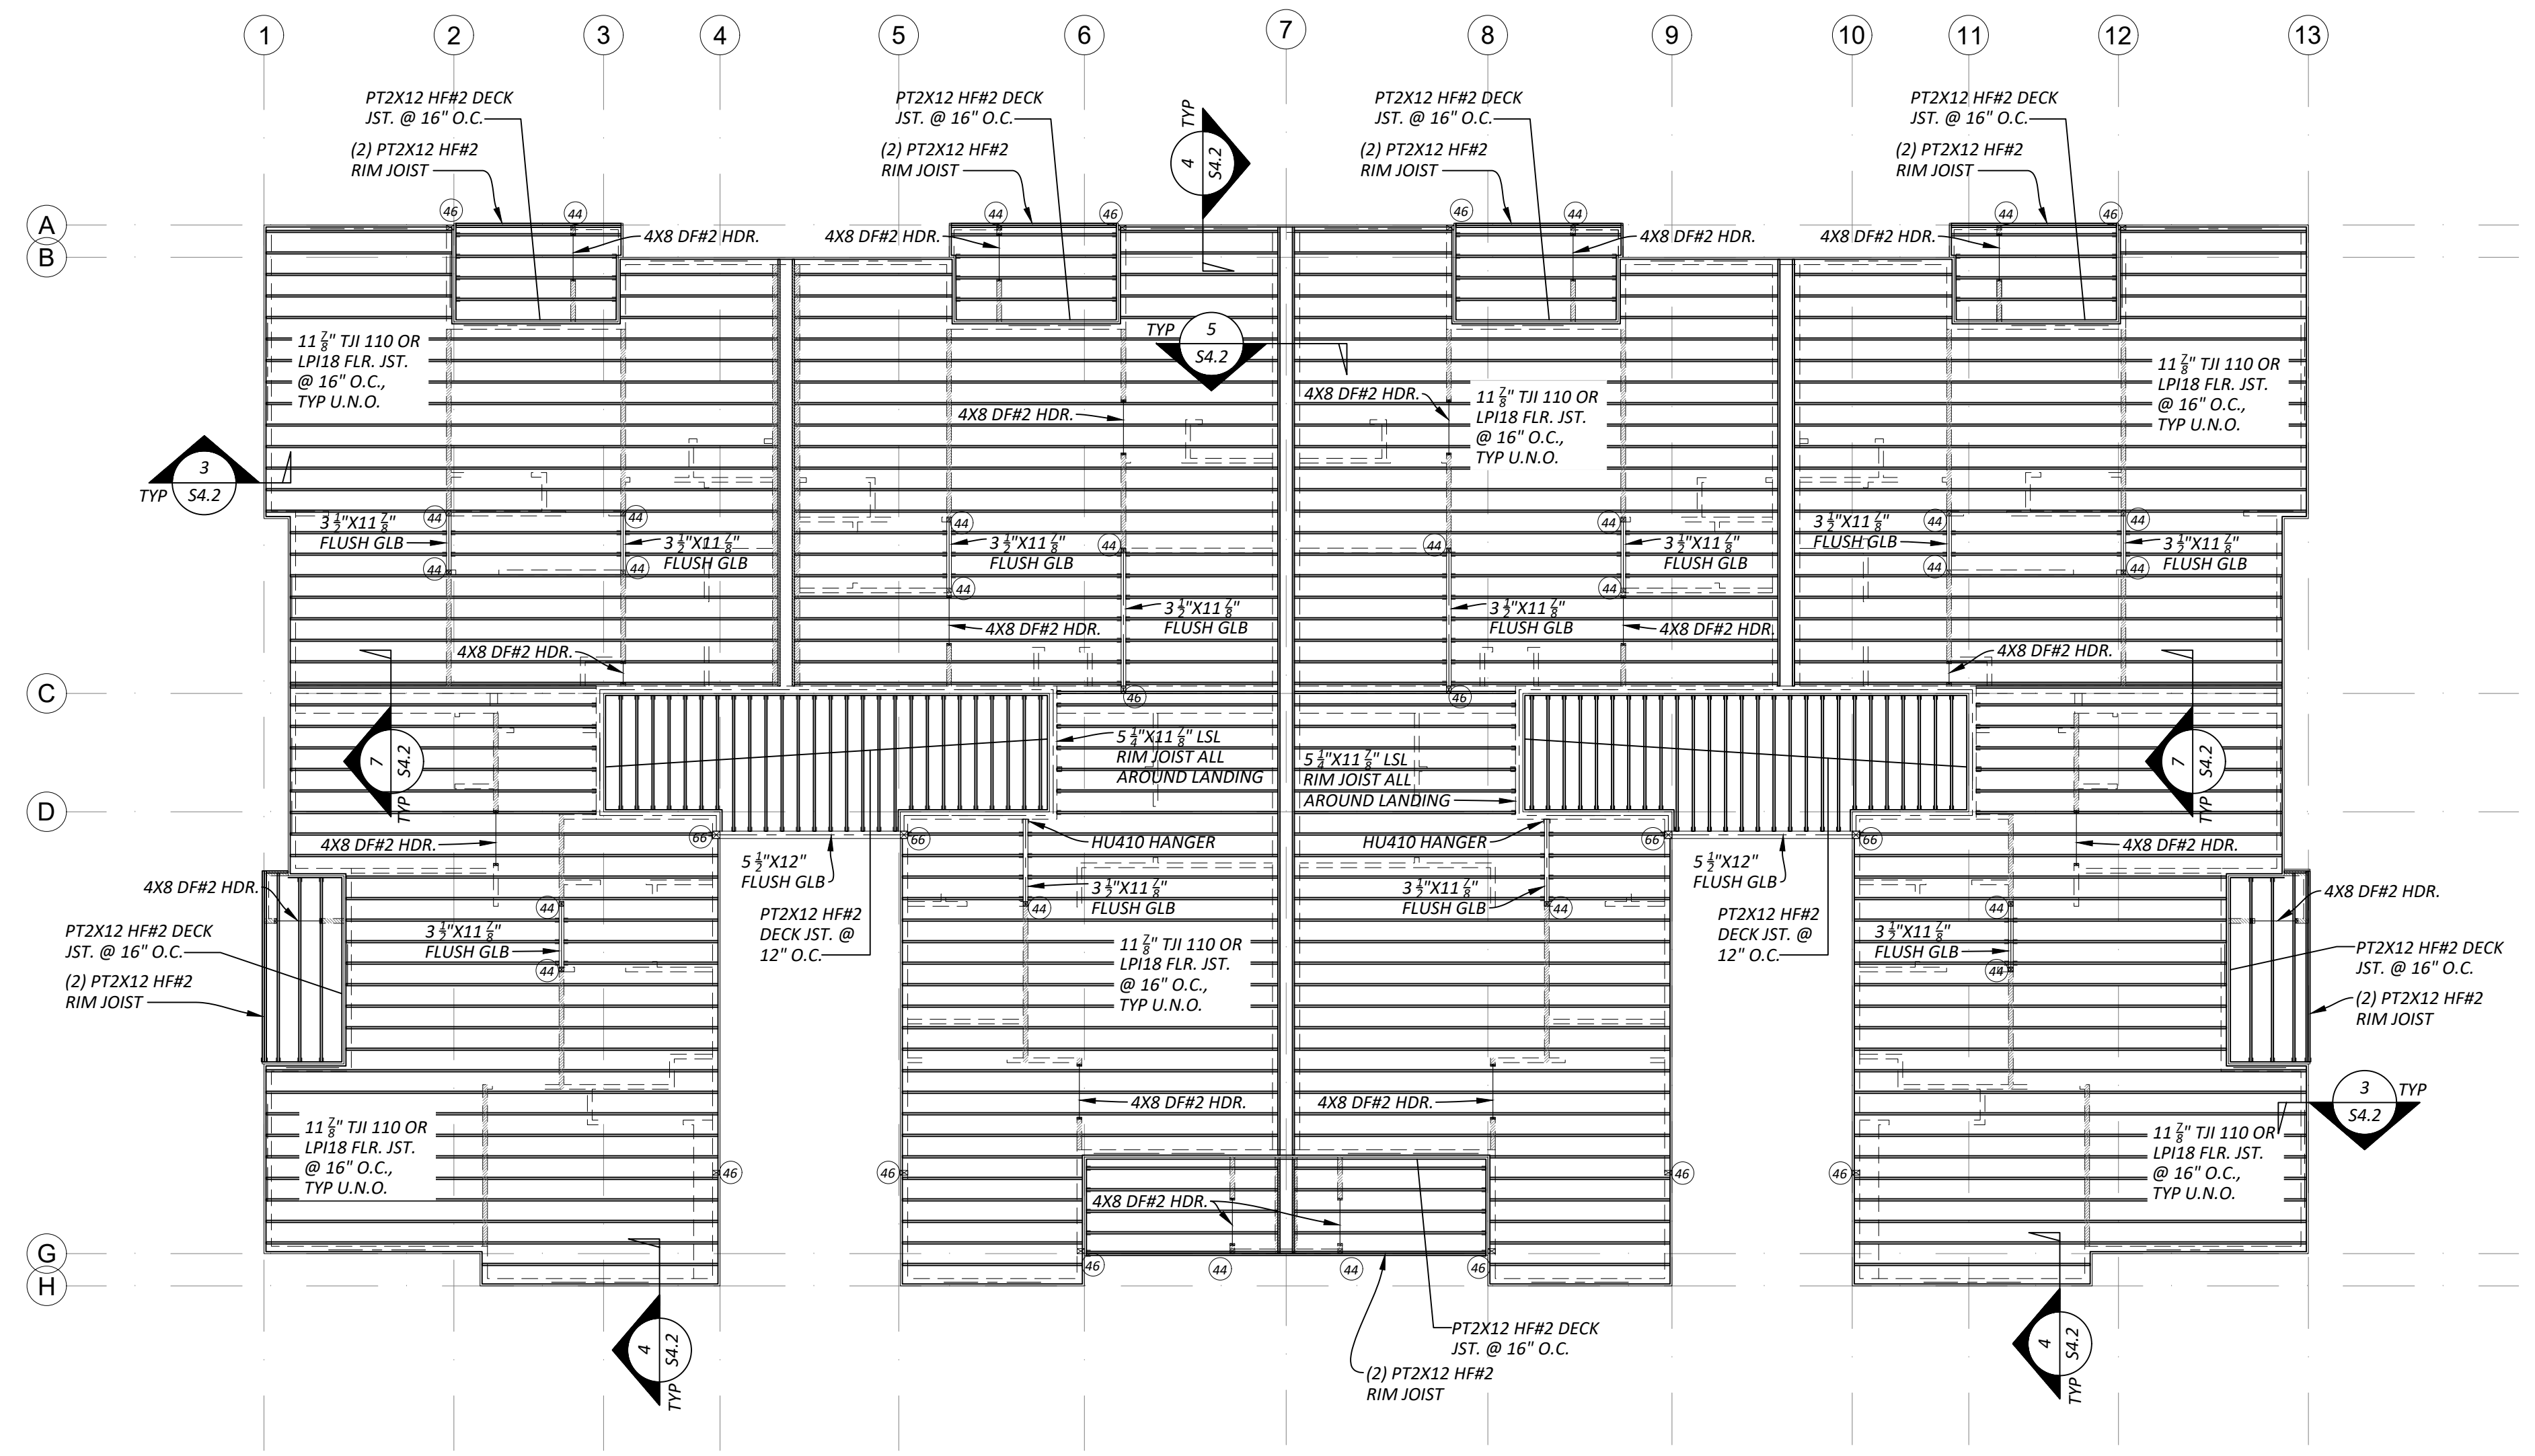


LEVEL 3 FRAMING PLAN
1/8" = 1'-0"

POST SCHEDULE

POST NUMBER	POST TYPE	ALTERNATIVE BUILT-UP POST
44	4X4 DF#2	(3) 2X4 DF#2 STUDS
46	4X6 DF#2	(3) 2X6 DF#2 STUDS
64	4X6 DF#2	(4) 2X4 DF#2 STUDS
66	6X6 DF#2	(4) 2X6 DF#2 STUDS
68	6X8 DF#2	(5) 2X6 DF#2 STUDS

- NOTES:**
- USE MIN. 6" WIDE POST BELOW BEAM SPLICES
 - USE 4X4 DF#2 POST BELOW 4X BEAMS, U.N.O.
 - USE 6X6 DF#2 POST BELOW 6X BEAMS, U.N.O.

- NOTES:**
- ALL COLUMNS NOT SPECIFIED OR OTHERWISE NOTED ON THE PLANS ARE LAMINATED TOGETHER PER "TYPICAL BUILT-UP COLUMN DETAIL" ON SHEET S4.2. SOLID WOOD COLUMNS MAY BE SUBSTITUTED FOR BUILT-UP COLUMNS BY PROVIDING AN EQUIVALENT CROSS SECTIONAL AREA.
 - ALL BEAMS SHALL HAVE A MINIMUM OF 3X BUILT-UP COLUMN WITH CONTINUOUS LOAD PATH TO FOUNDATION.
 - ALL HEADERS UNLESS SPECIFIED ON THE PLANS ARE TO BE 4X10 DF-L #2 WITH AT LEAST ONE CRIPPLE AND ONE STUD FOR EACH END FOR OPENINGS LESS THAN OR EQUAL TO 5'-0" WIDE AND TWO CRIPPLES AND ON KING STUD FOR ALL OTHERS.
 - ALL TJI FLOOR JOIST HUNG FROM FLUSH BEAMS SHALL BE HUNG WITH IUS SERIES HANGERS.
 - ALL RIM JOIST SHALL BE 1 1/4" X 11 3/4" LSL U.N.O. SEE SHEAR WALL TABLE TO AREAS REQUIRING THICKER RIM JOIST.
 - FLOOR SHEATHING SHALL BE 3/8" T&G (48/24) GLUED AND NAILED WITH 10d @ 6" O.C. ALONG PANEL EDGES AND 12" O.C. FIELD. STAGGER END LAPS. NAILS SHALL EMBED 1 1/2" MINIMUM INTO FLOOR JOIST.
 - SHORT MID LANDING STAIR STRINGERS SHALL BE PT4X12 HF#2.
 - LONG GROUND FLOOR STAIR STRINGERS SHALL BE PT3 1/2" X 12" GLB.
 - EXTERIOR WALLS TO BE 2X6 AT 16" O.C., U.N.O.
 - INTERIOR PARTITIONS TO BE 2X4 AT 16" O.C. (2X6 @ PLUMBING WALLS OR PER ARCH.) U.N.O.
 - FLOOR JOISTS AND BEAMS OF EQUAL OR BETTER CAPACITY MAY BE SUBSTITUTED FOR THOSE SHOWN ON THIS PLAN, "EQUAL" IS DEFINED AS HAVING MOMENT CAPACITY, SHEAR CAPACITY, AND STIFFNESS WITHIN 3% OF THE SPECIFIED JOISTS OR BEAMS.



PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
378 N. BENNETT ST.
TACOMA, WA 98402

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE DESIGN DETAILS OF ANY WORK HEREON ARE THE PROPERTY OF PIERUCCIONI E&C, LLC AND ARE NOT TO BE REPRODUCED OR COPIED IN WHOLE OR IN PART WITHOUT THE WRITTEN AUTHORIZATION OF PIERUCCIONI E&C, LLC.


EAST TOWN CROSSING
BUILDING "F"
PIONEER & SHAW PUYALLUP WA

REVISIONS

NO.	DATE	DESCRIPTION
01	---	---

REVISIONS

DRAWN BY: CP
CHECKED BY: CP
DATE: 2024.02.28
TITLE: FRAMING PLAN
PROJECT #: ---
SHEET:

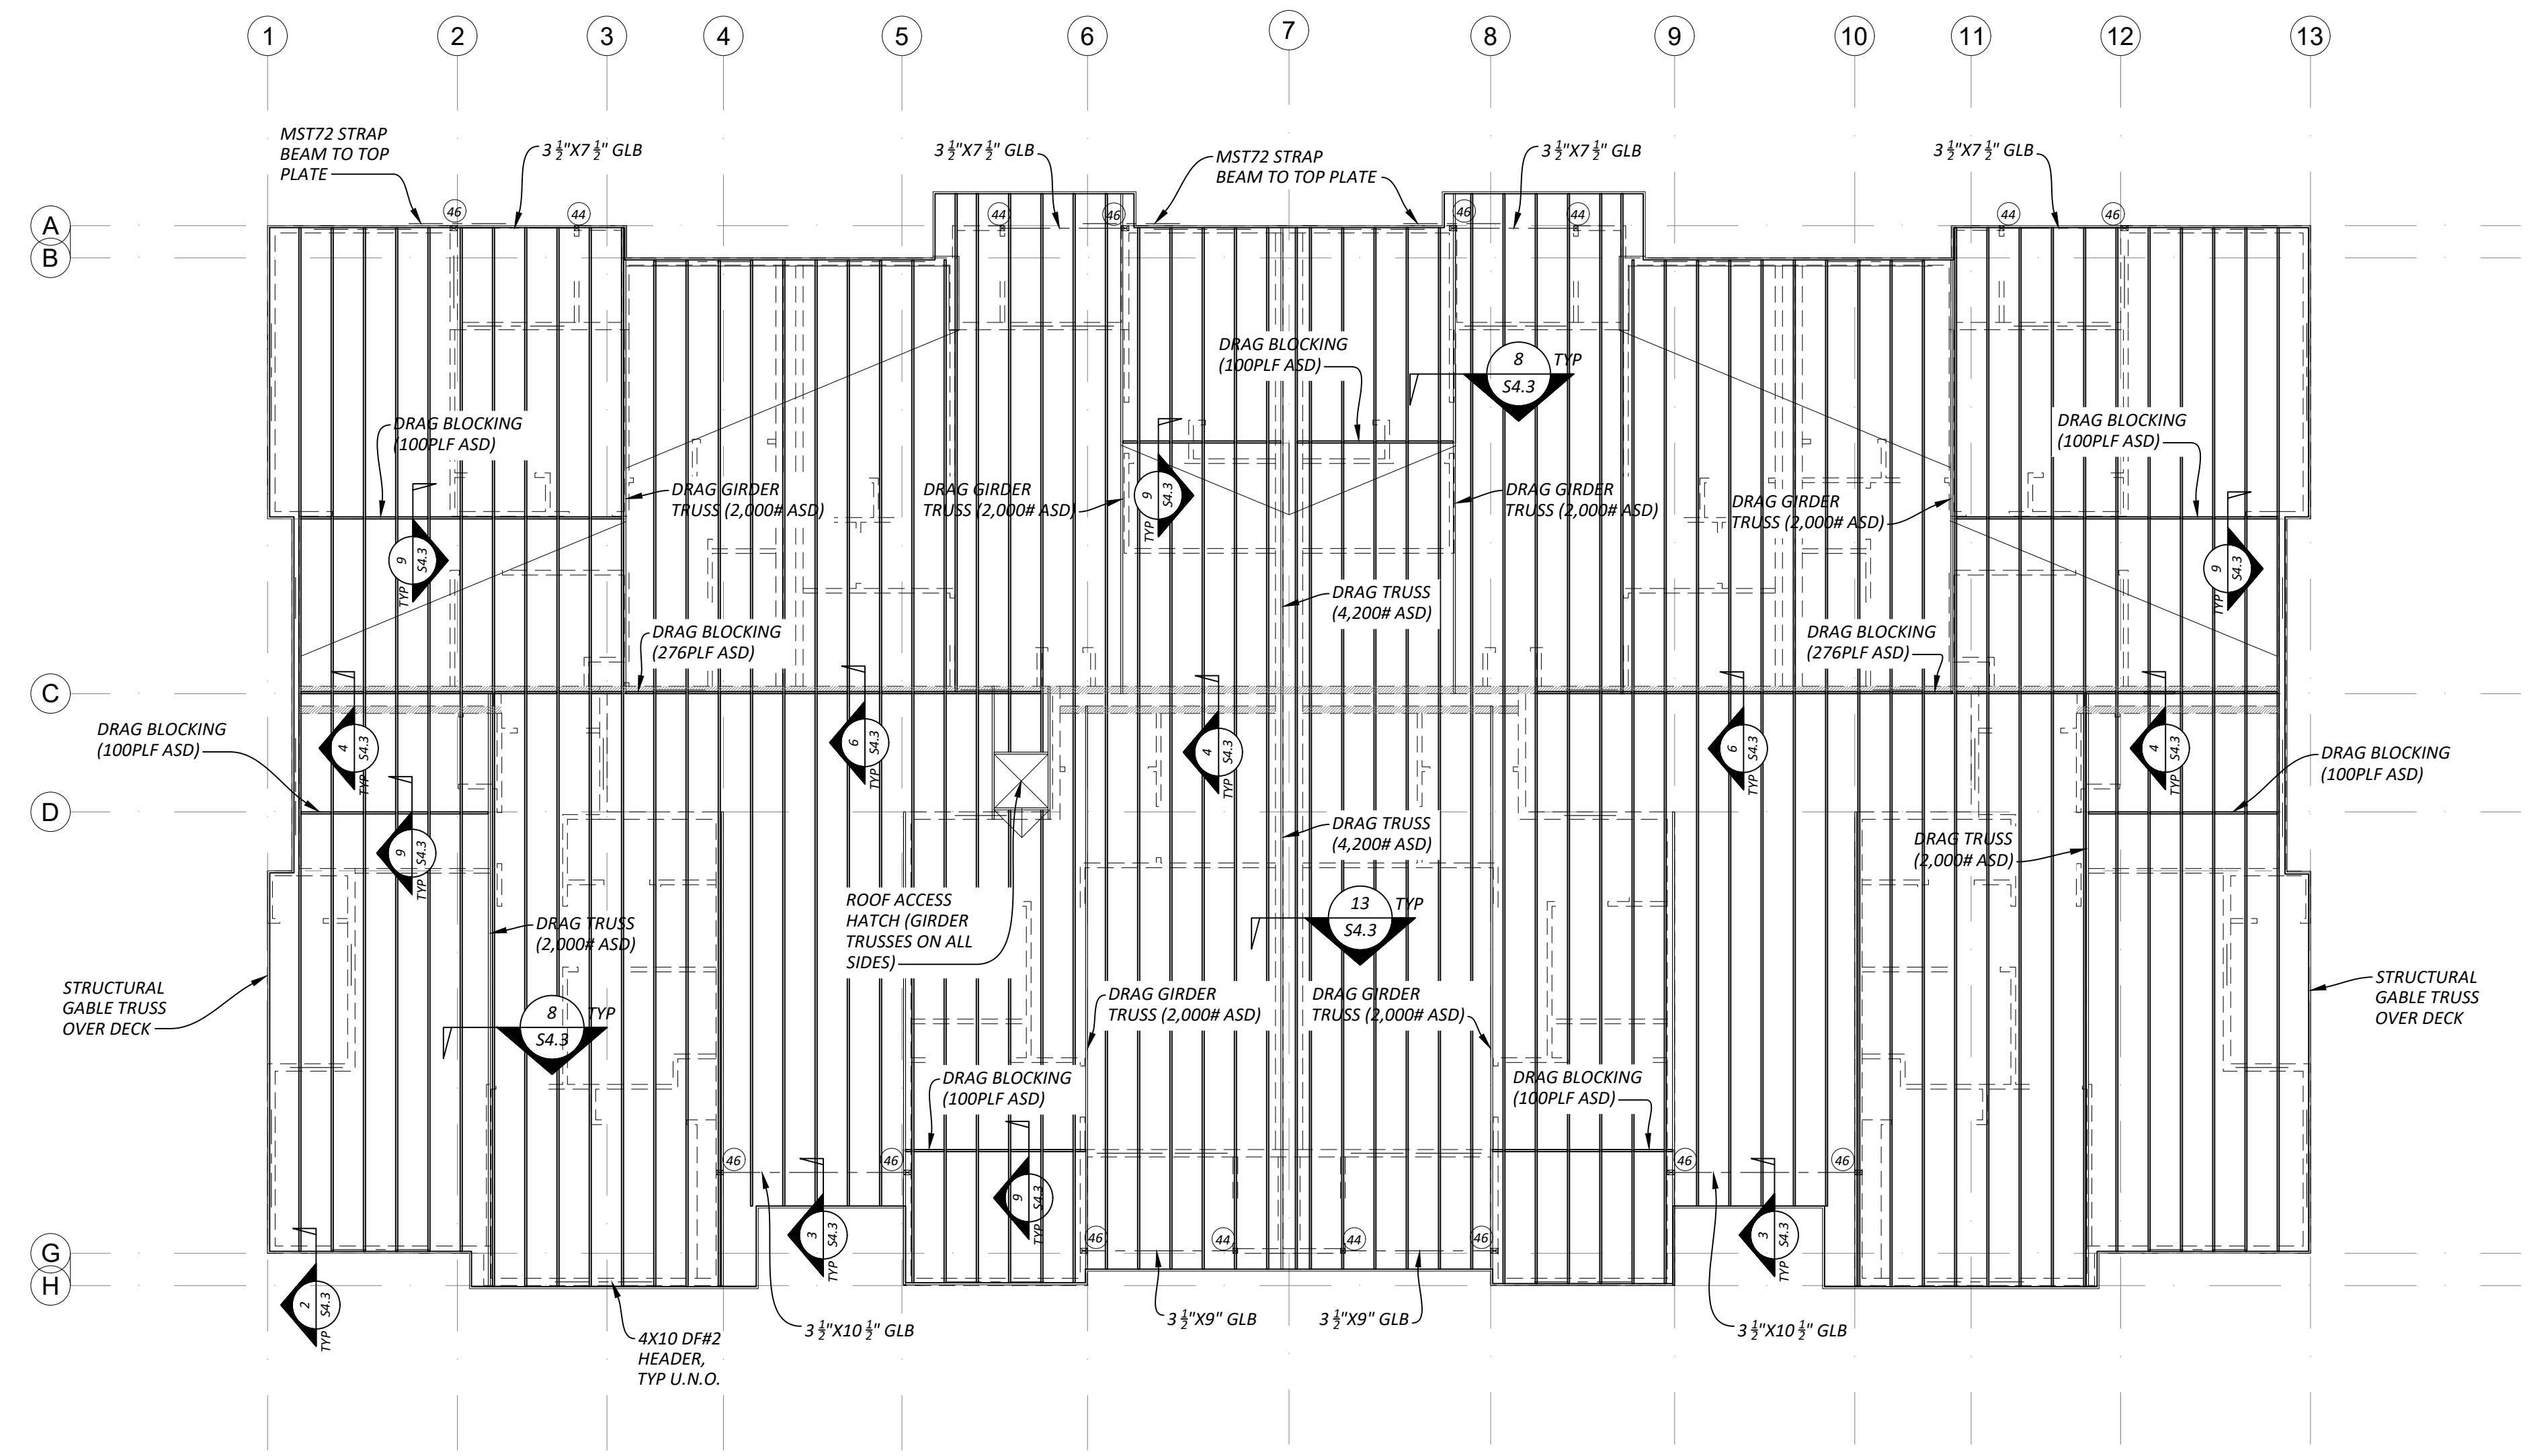

LOWER ROOF FRAMING PLAN
1/8" = 1'-0"

POST SCHEDULE

POST NUMBER	POST TYPE	ALTERNATIVE BUILT-UP POST
44	4X4 DF#2	(3) 2X4 DF#2 STUDS
46	4X6 DF#2	(3) 2X6 DF#2 STUDS
64	4X6 DF#2	(4) 2X4 DF#2 STUDS
66	6X6 DF#2	(4) 2X6 DF#2 STUDS
68	6X8 DF#2	(5) 2X6 DF#2 STUDS

- NOTES:**
- USE MIN. 6" WIDE POST BELOW BEAM SPLICES
 - USE 4X4 DF#2 POST BELOW 4X BEAMS, U.N.O.
 - USE 6X6 DF#2 POST BELOW 6X BEAMS, U.N.O.

- NOTES:**
- ALL COLUMNS NOT SPECIFIED OR OTHERWISE NOTED ON THE PLANS ARE LAMINATED TOGETHER PER "TYPICAL BUILT-COLUMN DETAIL" ON SHEET S4.2. SOLID WOOD COLUMNS MAY BE SUBSTITUTED FOR BUILT-UP COLUMNS BY PROVIDING AN EQUIVALENT CROSS SECTIONAL AREA.
 - ALL HEADERS UNLESS SPECIFIED ON THE PLANS ARE TO BE 4X10 DF-L #2 WITH AT LEAST ONE CRIPPLE AND ONE STUD FOR EACH END FOR OPENINGS LESS THAN OR EQUAL TO 5'-0" WIDE AND TWO CRIPPLES AND ON KING STUD FOR ALL OTHERS.
 - ROOF SHEATHING SHALL BE 1/2" CDX OR 7/16" OSB NAILED WITH 8d @ 6" O.C. ALONG PANEL EDGES, AND 12" O.C. FIELD. SPAN INDEX SHALL BE 24/0. STAGGER END LAPS. NAILS SHALL MINIMUM 1 1/2" EMBED INTO ROOF STRUCTURE BELOW.
 - BEARING WALLS ARE INDICATED AS SHADED WALLS
 - PROVIDE VENTED BLOCKING AT REQUIRED TRUSS/RAFTER BAYS
 - SHADED AREAS INDICATE OVERFRAMING. ROOF OVER FRAMING (IRC SECTION R802.3): RAFTERS SHALL BE FRAMED TO 2X RIDGE BOARD PER PLAN. RIDGE BOARD SHALL NOT BE LESS IN DEPTH THAN THE CUT END OF THE RAFTER. AT ALL VALLEYS AND HIPS THERE SHALL BE A 2X VALLEY OR HIP RAFTER AND NOT LESS IN DEPTH THAN THE CUT END OR THE RAFTER. (FULL COVERAGE AT RIDGE, HIPS AND VALLEYS).
 - ALL MANUFACTURED TRUSSES:
 - * SHALL NOT BE FIELD ALTERED WITHOUT ENGINEER'S APPROVAL
 - * SHALL HAVE DESIGN DETAILS AND DRAWINGS ON SITE FOR FRAMING INSPECTION
 - * SHALL BE INSTALLED AND BRACED TO MANUFACTURER'S SPECIFICATION
 - * SHALL CARRY MANUFACTURER'S STAMP ON EACH TRUSS
 - IF AN ENGINEERED ROOF FRAMING LAYOUT IS PROVIDED BY THE TRUSS SUPPLIER, THAT TRUSS LAYOUT SHALL SUPERCEDE THE TRUSS LAYOUT INDICATED IN THE PLANS. PROVIDE TRUSS LAYOUT AND SPECS ON SITE FOR INSPECTION.
 - PROVIDE SOLID FRAMING EQUAL TO THE WIDTH OF THE MEMBER BEING SUPPORTED (U.N.O.)



PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
3728 N. BENNETT ST.
TACOMA, WA 98407

REUSE OF DOCUMENTS
THIS DOCUMENT IS THE PROPERTY OF PIERUCCIONI E&C, LLC. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN. ANY REUSE OF THIS DOCUMENT FOR ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF PIERUCCIONI E&C, LLC IS PROHIBITED.

EAST TOWN CROSSING
BUILDING "F"
PIONEER & SHAW PUYALLUP WA

REVISIONS

NO.	DESCRIPTION
01	---

REVISIONS

DRAWN BY:	CP
CHECKED BY:	CP
DATE:	2024.02.28
TITLE:	FRAMING PLAN
PROJECT #:	---
SHEET:	

S3.4

A

B

C


D

E

F

G

H

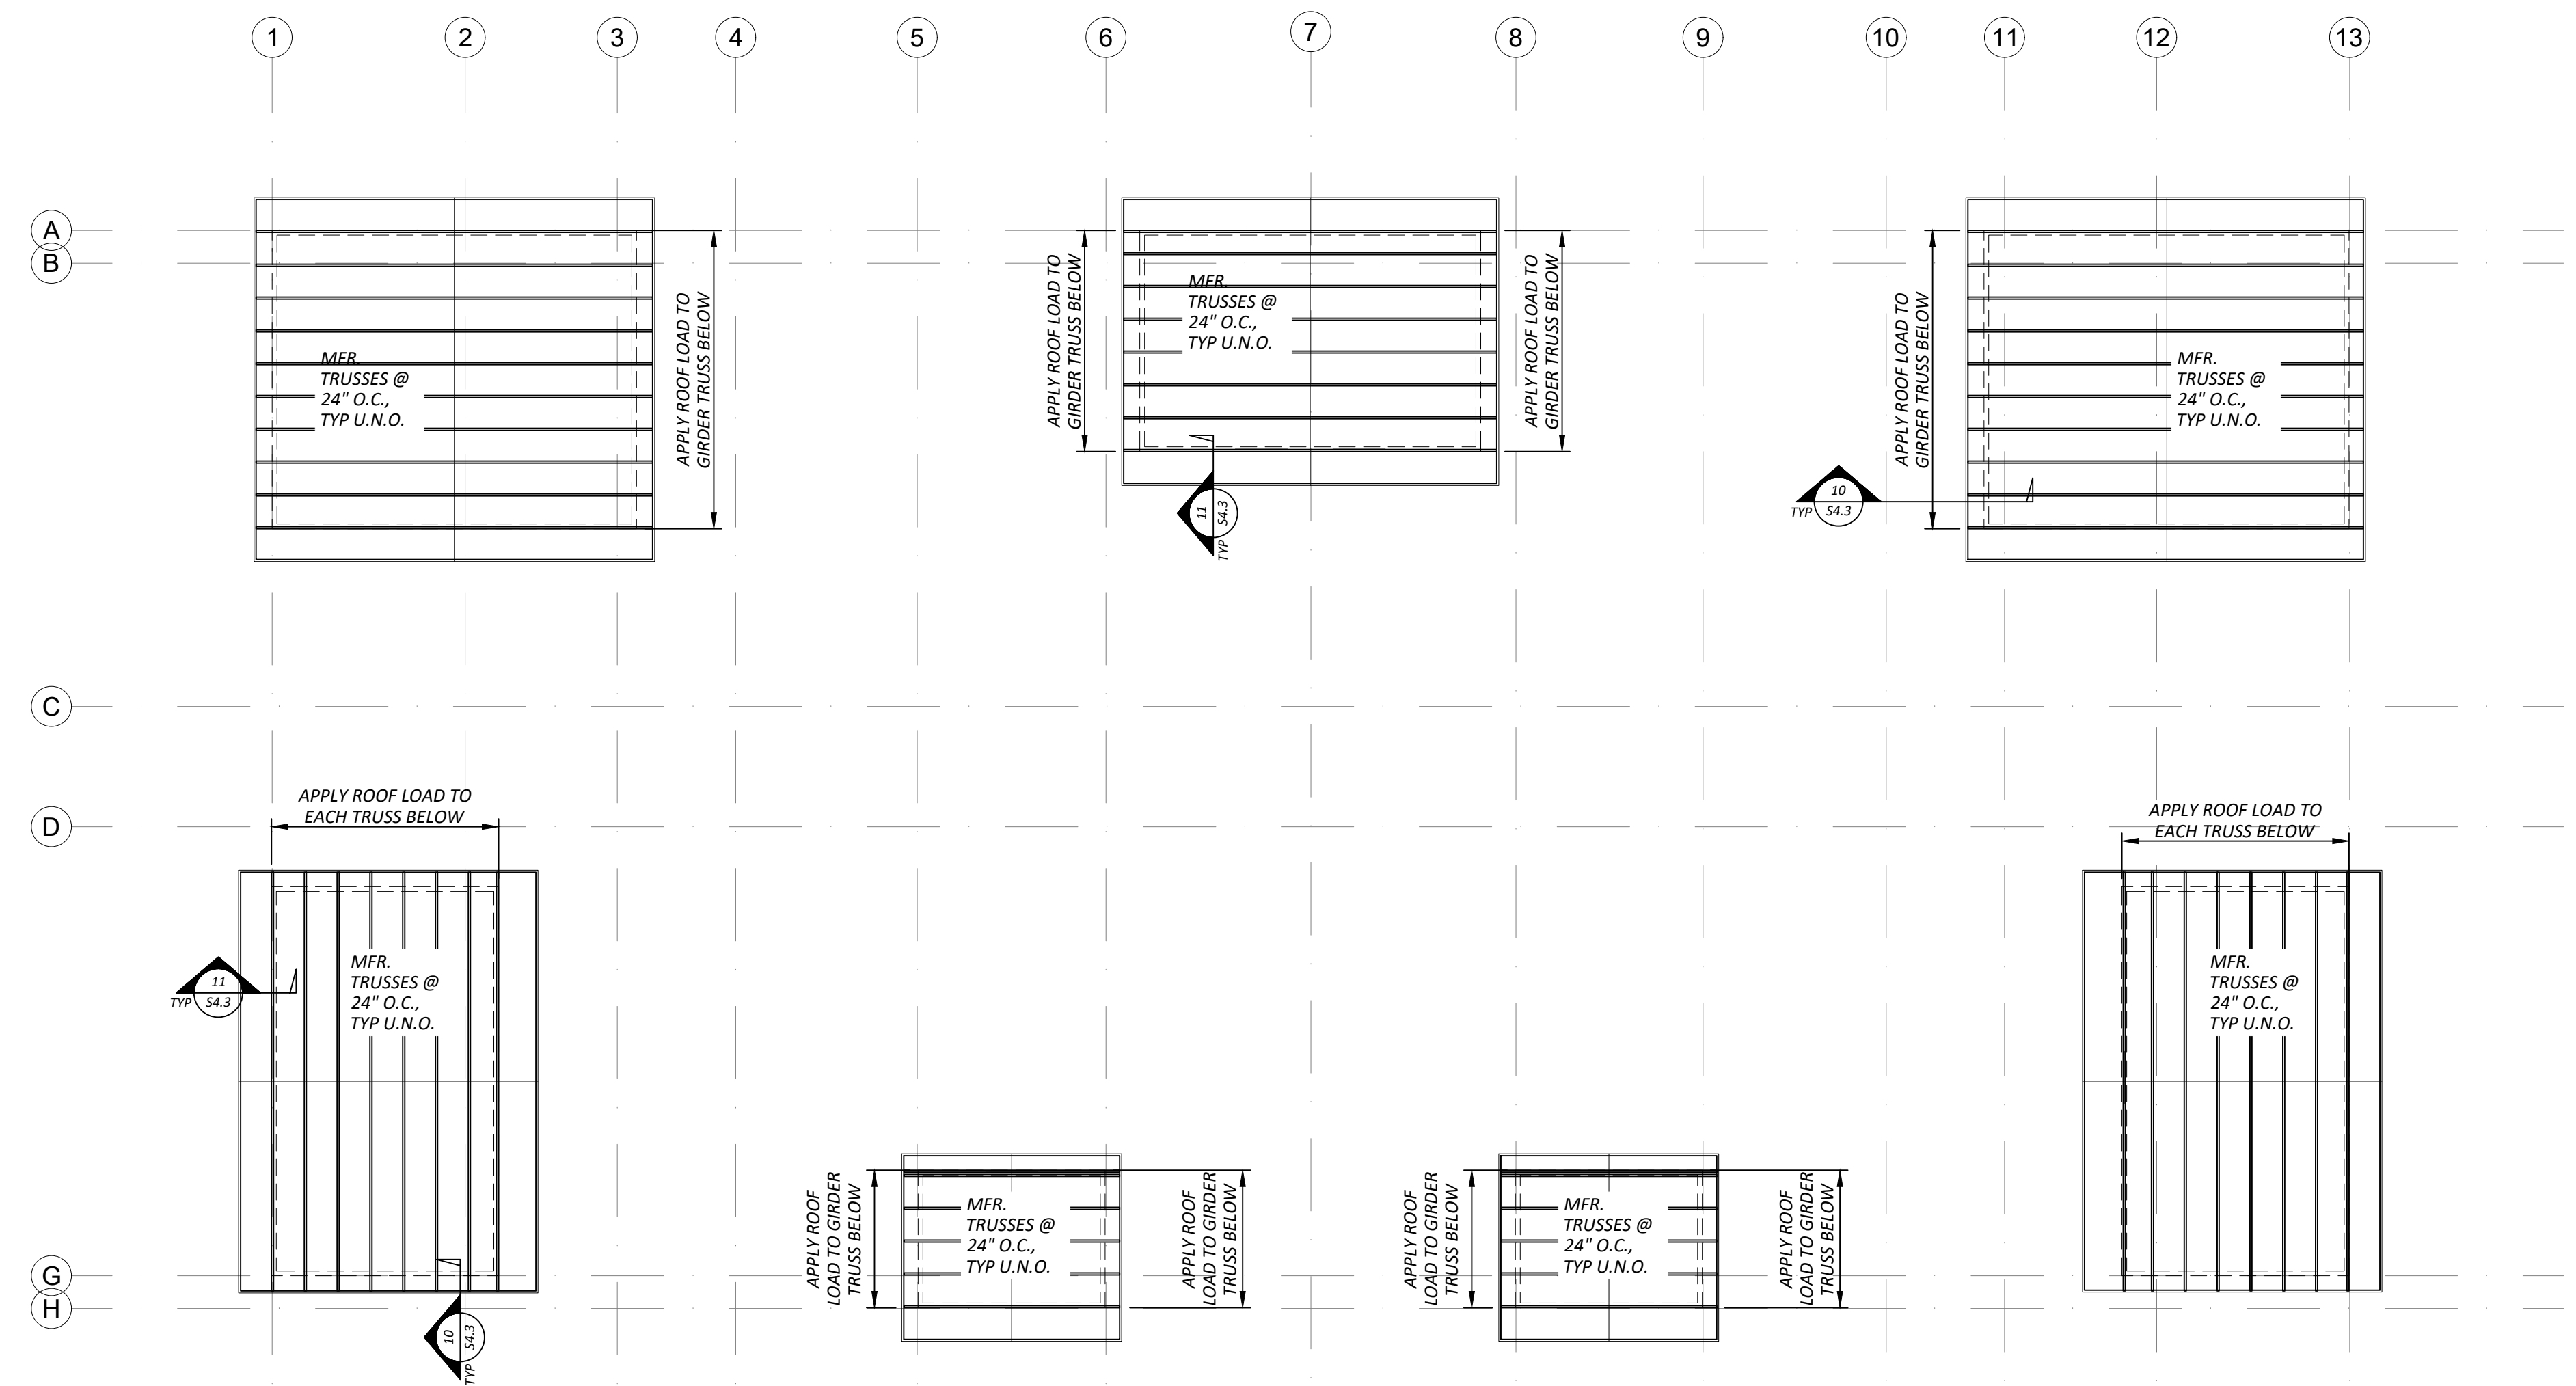

UPPER ROOF FRAMING PLAN
1/8" = 1'-0"

- NOTES:**
- ALL COLUMNS NOT SPECIFIED OR OTHERWISE NOTED ON THE PLANS ARE LAMINATED TOGETHER PER "TYPICAL BUILT-COLUMN DETAIL" ON SHEET S4.2. SOLID WOOD COLUMNS MAY BE SUBSTITUTED FOR BUILT-UP COLUMNS BY PROVIDING AN EQUIVALENT CROSS SECTIONAL AREA.
 - ALL HEADERS UNLESS SPECIFIED ON THE PLANS ARE TO BE 4X10 DF-L #2 WITH AT LEAST ONE CRIPPLE AND ONE STUD FOR EACH END FOR OPENINGS LESS THAN OR EQUAL TO 5'-0" WIDE AND TWO CRIPPLES AND ON KING STUD FOR ALL OTHERS.
 - ROOF SHEATHING SHALL BE 1/2" CDX OR 7/16" OSB NAILED WITH 8d @ 6" O.C. ALONG PANEL EDGES, AND 12" O.C. FIELD. SPAN INDEX SHALL BE 24/0. STAGGER END LAPS. NAILS SHALL MINIMUM 1 1/2" EMBED INTO ROOF STRUCTURE BELOW.
 - BEARING WALLS ARE INDICATED AS SHADED WALLS
 - PROVIDE VENTED BLOCKING AT REQUIRED TRUSS/RAFTER BAYS
 - ALL MANUFACTURED TRUSSES:
 - * SHALL NOT BE FIELD ALTERED WITHOUT ENGINEER'S APPROVAL
 - * SHALL HAVE DESIGN DETAILS AND DRAWINGS ON SITE FOR FRAMING INSPECTION
 - * SHALL BE INSTALLED AND BRACED TO MANUFACTURER'S SPECIFICATION
 - * SHALL CARRY MANUFACTURER'S STAMP ON EACH TRUSS
 - IF AN ENGINEERED ROOF FRAMING LAYOUT IS PROVIDED BY THE TRUSS SUPPLIER, THAT TRUSS LAYOUT SHALL SUPERCEDE THE TRUSS LAYOUT INDICATED IN THE PLANS. PROVIDE TRUSS LAYOUT AND SPECS ON SITE FOR INSPECTION.
 - PROVIDE SOLID FRAMING EQUAL TO THE WIDTH OF THE MEMBER BEING SUPPORTED (U.N.O.)



PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
378 N. BENNETT ST.
TACOMA, WA 98407

REUSE OF DOCUMENTS
THIS DOCUMENT IS THE PROPERTY OF PIERUCCIONI E&C, LLC. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN. ANY REUSE OR REPRODUCTION IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF PIERUCCIONI E&C, LLC IS PROHIBITED.

EAST TOWN CROSSING
BUILDING "F"
PIONEER & SHAW PUYALLUP WA

REVISIONS

NO.	DESCRIPTION
01	---

REVISIONS

DRAWN BY: CP
CHECKED BY: CP
DATE: 2024.02.28
TITLE: FRAMING PLAN
PROJECT #: ---
SHEET:


S3.5



PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
378 N. BENNETT ST.
TACOMA, WA 98407

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE DESIGN DETAILS OF
PROFESSIONAL OPINION, AND THE PROPERTY OF
PIERUCCIONI E&C, LLC. IT IS TO BE USED ONLY
AS SPECIFIED IN THE ORIGINAL CONTRACT. THE
REGISTERED PROFESSIONAL OF PIERUCCIONI E&C, LLC.

EAST TOWN CROSSING
BUILDING "F"
PIONEER & SHAW PUYALLUP WA

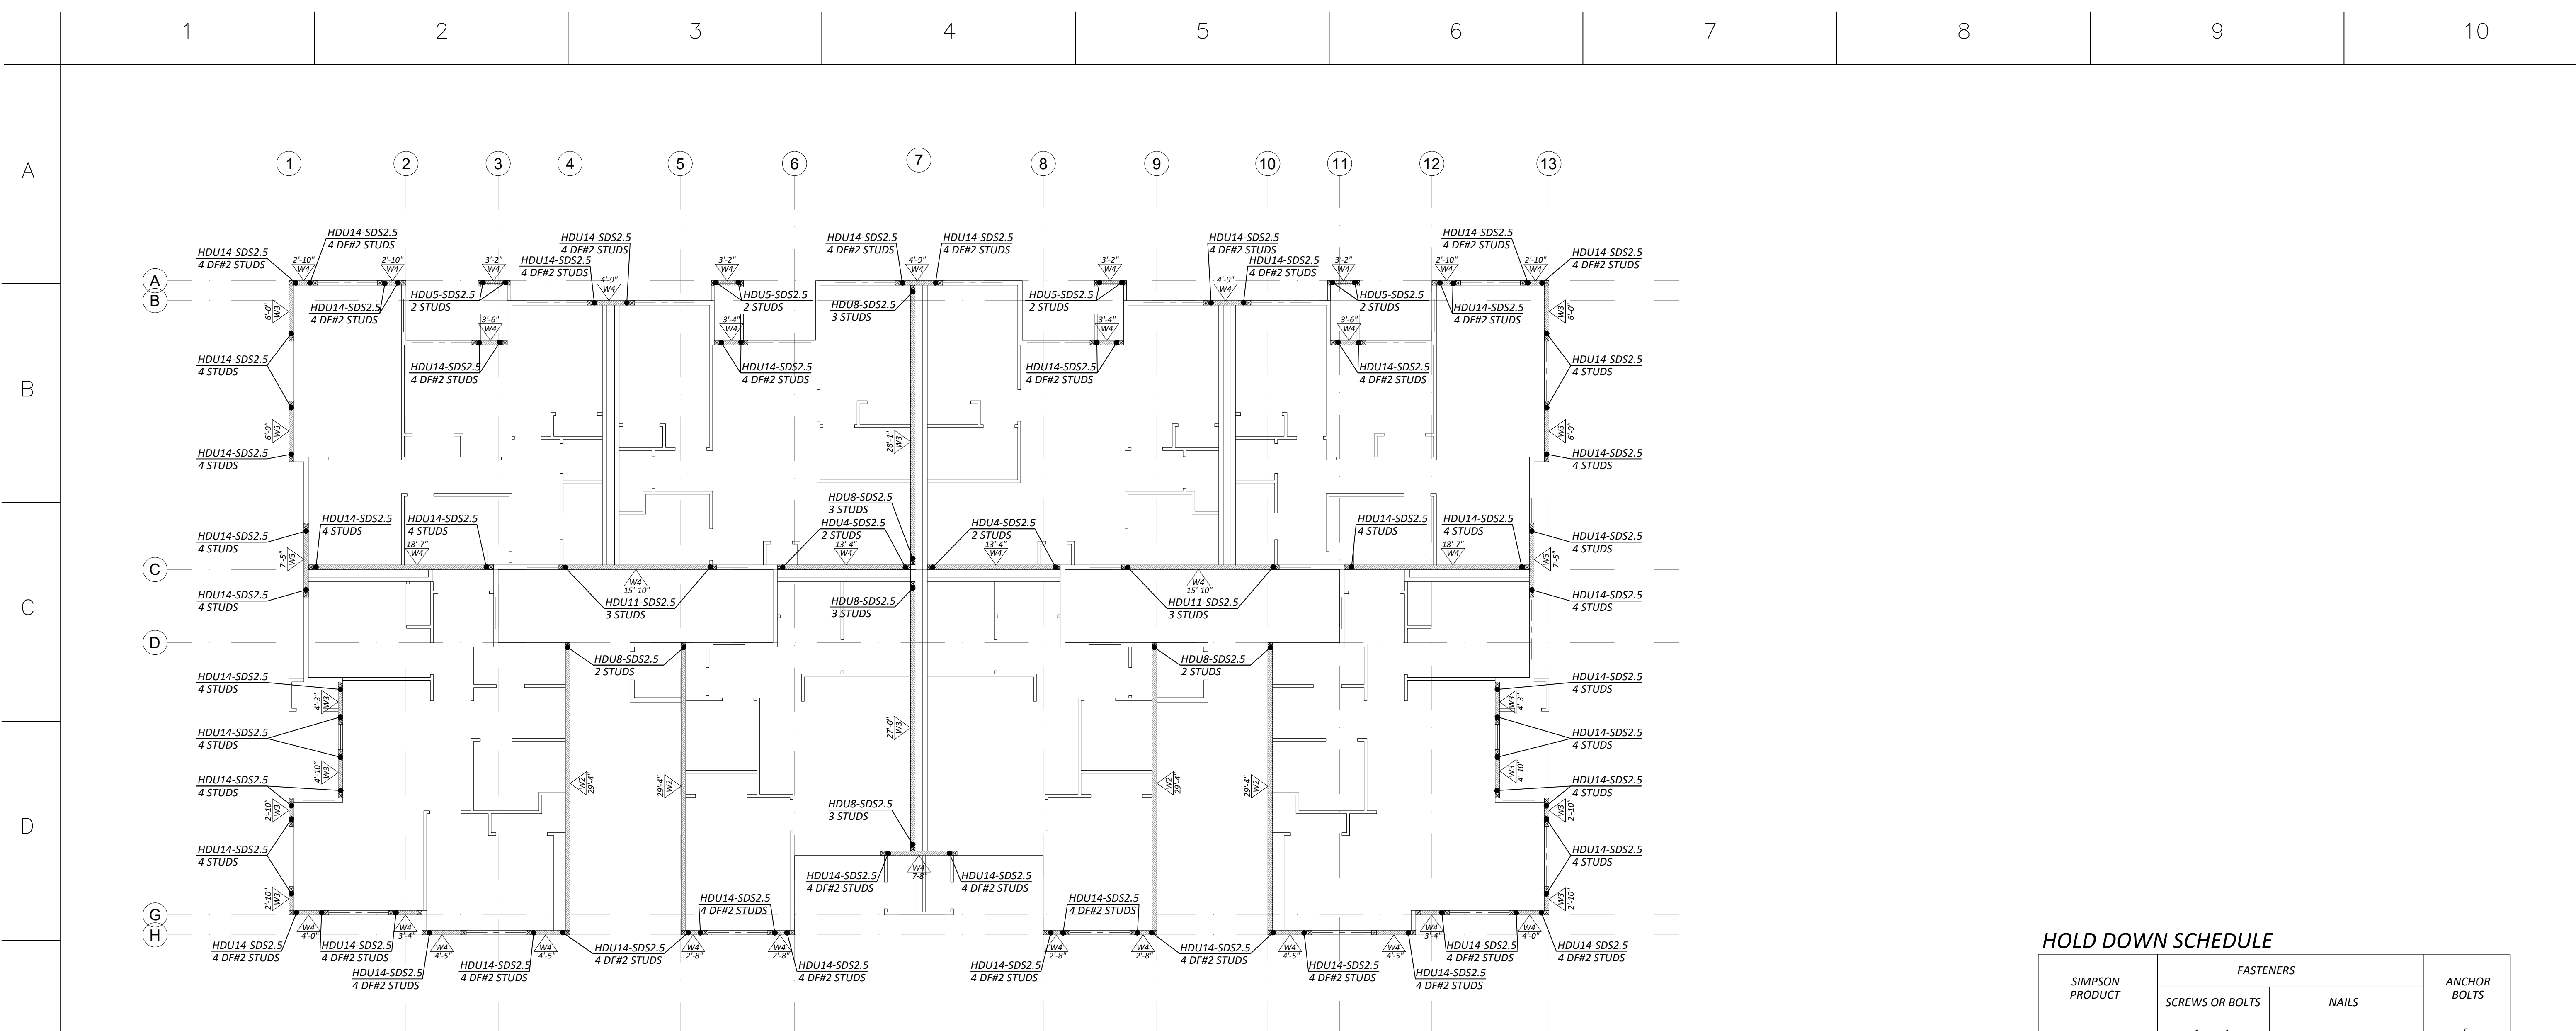

LEVEL 1 SHEAR WALL PLAN
1/8" = 1'-0"

- NOTES:
1. ALL EXTERIOR WALL SHALL BE SHEAR WALL TYPE W1 UNLESS NOTED OTHERWISE.

**SPECIAL INSPECTIONS ARE
REQUIRED FOR SHEAR
WALLS:**

HOLD DOWN SCHEDULE

SIMPSON PRODUCT	FASTENERS		ANCHOR BOLTS
	SCREWS OR BOLTS	NAILS	
HDU4-SDS2.5	(10) 1/2" X 2 1/2" SDS INTO POST PER PLAN	--	SB 3/24 (18" EMBED)
HDU5-SDS2.5	(14) 1/2" X 2 1/2" SDS INTO POST PER PLAN	--	SB 3/24 (18" EMBED)
HDU8-SDS2.5	(20) 1/2" X 2 1/2" SDS INTO POST PER PLAN	--	SB 3/24 (18" EMBED)
HDU11-SDS2.5	(30) 1/2" X 2 1/2" SDS INTO POST PER PLAN	--	SB 1X30 (24" EMBED)
HDU14-SDS2.5	(36) 1/2" X 2 1/2" SDS INTO POST PER PLAN	--	SB 1X30 (24" EMBED)

SHEAR WALL AND ANCHOR TABLE

WALL TYPE	APA RATED SHEATHING (b), (c)	MINIMUM NOMINAL THICKNESS (IN) (j)	MINIMUM NAIL PENETRATION IN FRAMING (IN) (i)	STUD & BLOCKING SIZE @ ADJOINING EDGES (k)	REQUIRED RIM JOIST THICKNESS	EDGE NAIL SIZE AND SPACING, COMMON OR GALV. BOX (d)	RIM JOIST OR BLOCK CONNECTION TO TOP PLATE (e), (f)	2x BOTTOM PLATE ATTACHMENT TO WOOD BELOW (g), (i)	ANCHOR BOLT SILL PLATE ATTACHMENT TO CONCRETE BELOW (h)	CAPACITY (PLF) SEISMIC/WIND
W1	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/4" LSL	8d@6" O.C. EDGE 8d@12" O.C. FIELD	LTP4 @ 20" O.C. OR A35 @ 16" O.C.	(1) 16d @ 8" O.C.	3/8" @ 48" O.C.	242/339
W2	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/4" LSL	8d@4" O.C. EDGE 8d@12" O.C. FIELD	LTP4 @ 14" O.C. OR A35 @ 11" O.C.	(1) 16d @ 6" O.C.	5/8" @ 36" O.C.	353/495
W3	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/4" LSL	8d@3" O.C. EDGE 8d@12" O.C. FIELD	LTP4 @ 11" O.C. OR A35 @ 8" O.C.	(1) 16d @ 4" O.C.	5/8" @ 24" O.C.	456/637
W4 (a)	OSB	7/16 (j)	1 3/8	3x	3x OR 1 3/4" LSL	8d@2" O.C. EDGE 8d@12" O.C. FIELD	LTP4 @ 8" O.C. OR A35 @ 6" O.C.	(2) 16d @ 6" O.C.	5/8" @ 24" O.C.	595/832

- (a) FRAMING AT ADJACENT PANELS SHALL BE 3" NOMINAL OR GREATER AND NAILS SHALL BE STAGGERED.
 (b) WHERE SHEATHING IS APPLIED ON BOTH SIDES OF WALL, PANEL EDGE JOINTS ON 2x FRAMING SHALL BE STAGGERED SO THAT JOINTS ON THE OPPOSITE SIDE ARE NOT LOCATED ON THE SAME STUDS.
 (c) BLOCKING IS REQUIRED AT ALL PANEL EDGES
 (d) PROVIDE SHEAR WALL SHEATHING AND NAILING FOR THE ENTIRE LENGTH OF THE WALLS INDICATED ON THE PLANS. ENDS OF FULL HEIGHT WALLS ARE DESIGNATED BY EXTERIOR OF THE BUILDING, CORRIDORS, WINDOW, OR DOORWAYS OR AS DESIGNATED ON THE PLANS. SEE PLANS FOR HOLD DOWN POSTS. SHEATHING EDGE NAILING IS REQUIRED AT ALL HOLD DOWN POSTS. EDGE NAILING MAY ALSO BE REQUIRED TO EACH STUD USED IN BUILT-UP HOLD DOWN POSTS.
 (e) BASED ON 0.131X 1 1/4" LONG NAILS USED TO ATTACH FRAMING CLIPS DIRECTLY TO FRAMING. USE 0.131X 2 1/2" NAILS WHERE INSTALLED OVER SHEATHING. USE A35 OR RBC CLIPS IN LIEU OF LTP'S FOR ROOF BLOCKING TO TOP PLATE.
 (f) LTP4'S ARE NOT REQUIRED WHERE THE LOWER WALL SHEATHING IS OVERLAPPED ONTO THE RIM JOIST A MINIMUM OF 1 1/2" AND NAILED TO THE RIM JOIST PER THE SHEAR WALL PERIMETER NAIL SPACING. LTP4'S MAY BE SUBSTITUTED W/ A35'S.
 (g) CONTINUOUS SHEATHING IS REQUIRED OVER THE BOTTOM PLATE TO THE BOTTOM OF THE RIM JOIST OR SILL PLATE WITH EDGE NAILING AT EACH. WHERE TWO ROWS OF NAILING ARE REQUIRED AT RAISED FLOORS, PROVIDE BLOCKING PER PLAN, AND ATTACH WITH LTP4 PER SCHEDULE.
 (h) ANCHOR BOLTS SHALL BE PROVIDED WITH STEEL PLATE WASHERS 0.229"x3"x3". EMBED ANCHOR BOLTS MINIMUM 7" INTO THE CONCRETE. PLATE WASHERS SHALL EXTEND TO WITHIN 1" OF THE SILL PLATE EDGE ON THE SHEATHED WALL FACE.
 (i) PRESSURE TREATED MATERIALS CAN CAUSE EXCESSIVE CORROSION IN THE FASTENERS. PROVIDE HOT-DIPPED GALVANIZED (ELECTROPLATING IS NOT ACCEPTABLE) NAILS AND CONNECTOR PLATES (FRAMING ANGLES, ETC.) FOR ALL CONNECTORS IN CONTACT WITH PRESSURE TREATED FRAMING MEMBERS.
 (j) ALL SHEAR WALL STUDS MUST BE SPACED NO MORE THAN 16" O.C.
 (k) 3x MEMBERS MAY BE SUBSTITUTED WITH 2 STUDS NAILED TOGETHER PER TYPICAL BUILT-UP COLUMN DETAIL (SEE DETAILS).

REVISIONS


NO.	DESCRIPTION
01	---

REVISIONS
 DRAWN BY: CP
 CHECKED BY: CP
 DATE: 2024.02.28
 TITLE: SHEAR WALL PLAN
 PROJECT #: ---
 SHEET:



PIERUCCI E&C, LLC
CHON PIERUCCI, PE
378 N. BENNETT ST.
TACOMA, WA 98407

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE DESIGN DETAILS OF
THE BUILDING ARE THE PROPERTY OF
PIERUCCI E&C, LLC AND ARE NOT TO BE
REPRODUCED OR TRANSMITTED IN ANY
MANNER OR BY ANY MEANS, WITHOUT THE
WRITTEN PERMISSION OF PIERUCCI E&C, LLC.

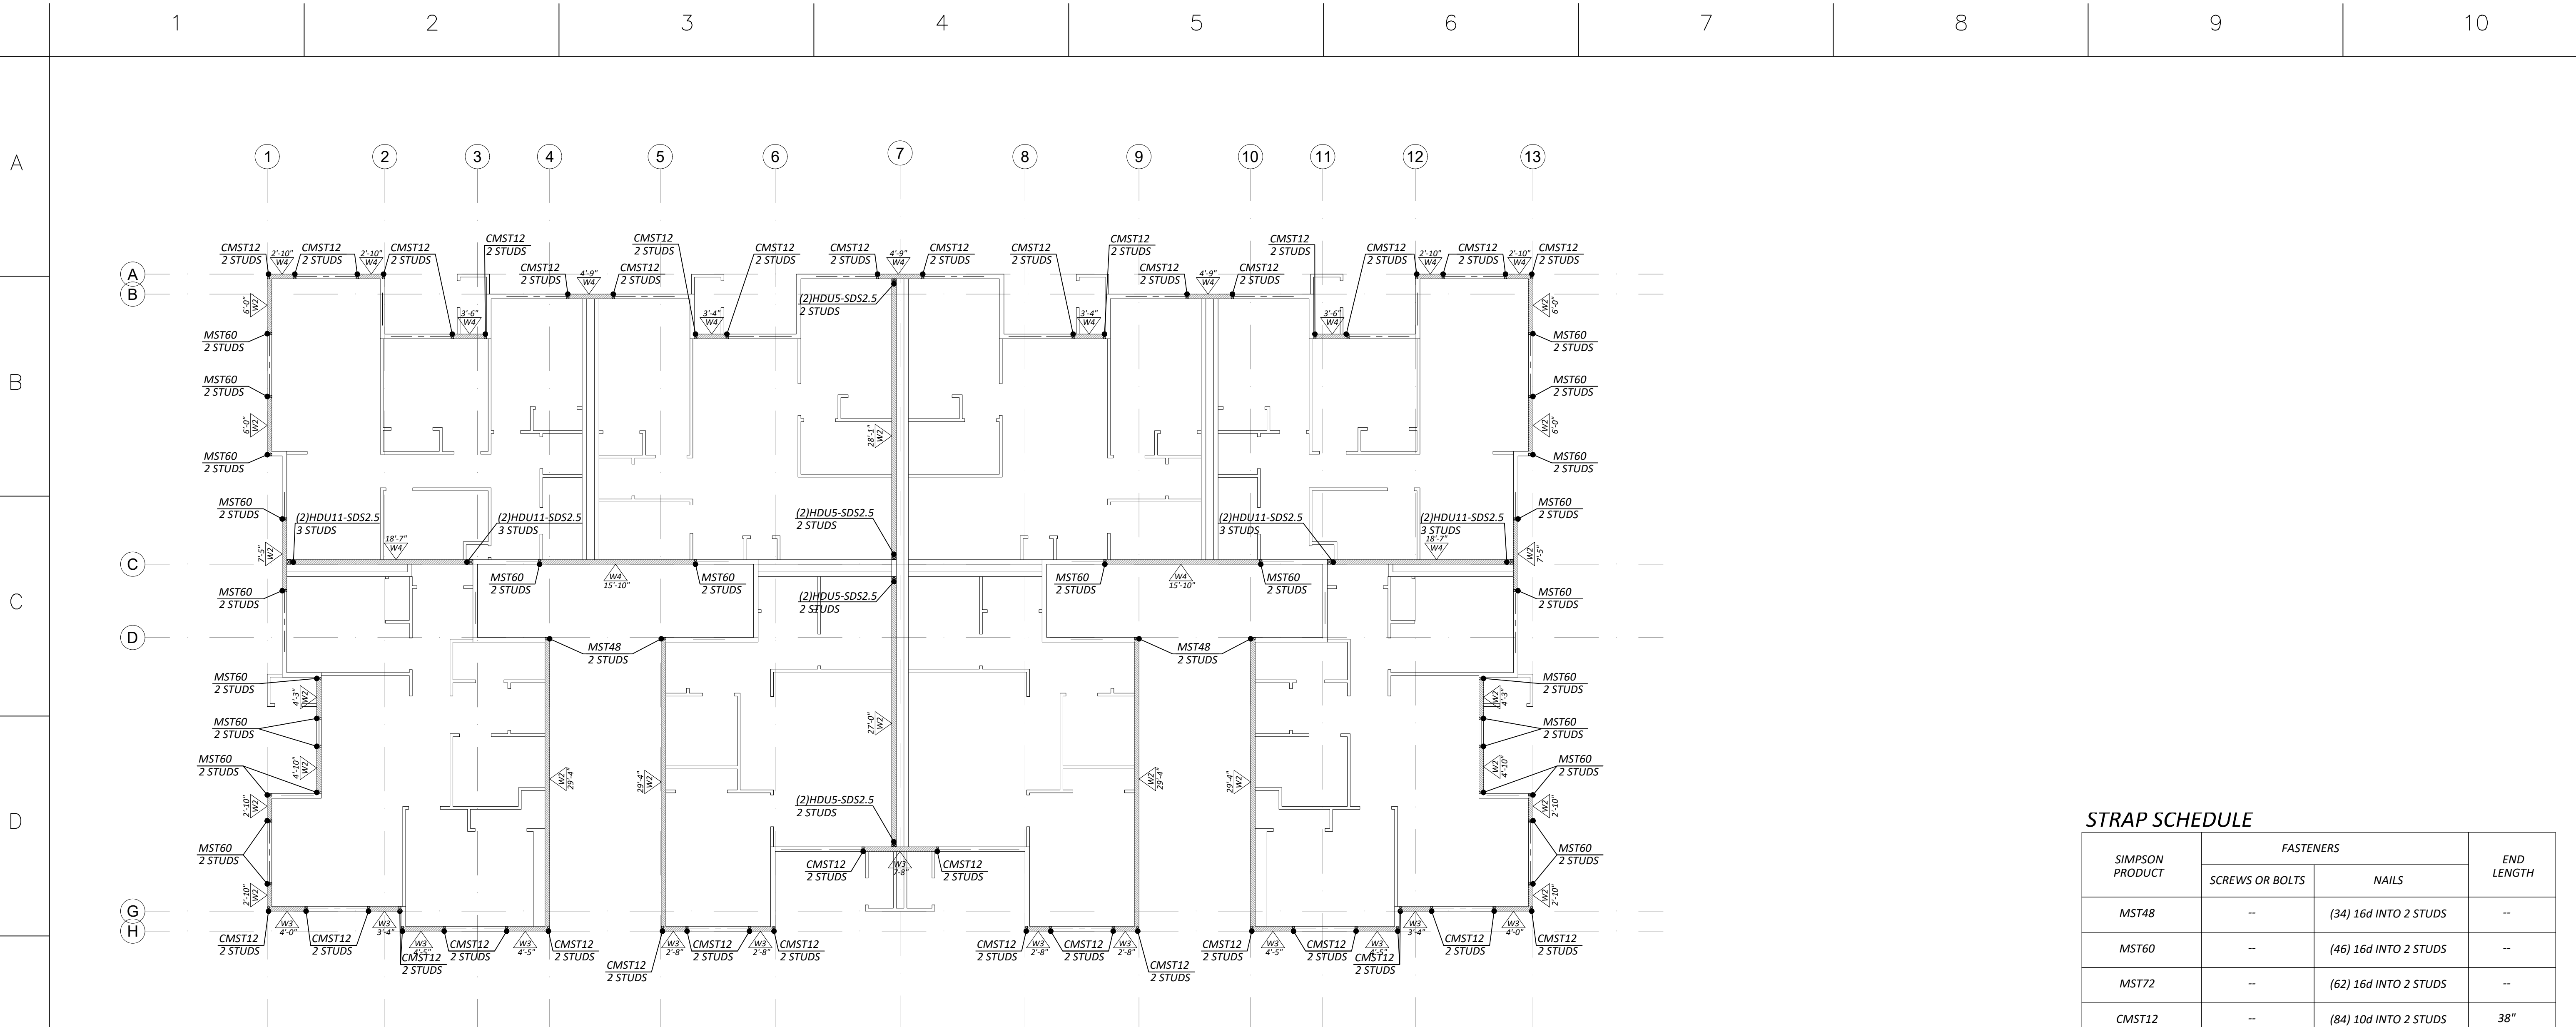

LEVEL 2 SHEAR WALL PLAN
1/8" = 1'-0"

- NOTES:
1. ALL EXTERIOR WALL SHALL BE SHEAR WALL TYPE W1 UNLESS NOTED OTHERWISE.

**SPECIAL INSPECTIONS ARE
REQUIRED FOR SHEAR
WALLS:**

STRAP SCHEDULE

SIMPSON PRODUCT	FASTENERS		END LENGTH
	SCREWS OR BOLTS	NAILS	
MST48	--	(34) 16d INTO 2 STUDS	--
MST60	--	(46) 16d INTO 2 STUDS	--
MST72	--	(62) 16d INTO 2 STUDS	--
CMST12	--	(84) 10d INTO 2 STUDS	38"

THRU FLOOR HOLD DOWN SCHEDULE

SIMPSON PRODUCT	FASTENERS		ANCHOR BOLTS
	SCREWS OR BOLTS	NAILS	
(2) HDUS-SDS2.5	(14) 3/4" X 2 1/2" SDS INTO POST PER PLAN	--	5/8" TREADED ROD
(2) HDU11-SDS2.5	(30) 3/4" X 2 1/2" SDS INTO POST PER PLAN	--	1" TREADED ROD

(a) THESE HOLD DOWNS ARE THRU FLOOR HOLD DOWN. TOTAL OF 2 HOLD DOWNS ARE REQUIRED (SEE DETAIL 2/S4.2).

SHEAR WALL AND ANCHOR TABLE

WALL TYPE	APA RATED SHEATHING (b), (c)	MINIMUM NOMINAL THICKNESS (IN) (f)	MINIMUM NAIL PENETRATION IN FRAMING (IN) (i)	STUD & BLOCKING SIZE @ ADJOINING EDGES (k)	REQUIRED RIM JOIST THICKNESS	EDGE NAIL SIZE AND SPACING, COMMON OR GALV. BOX (d)	RIM JOIST OR BLOCK CONNECTION TO TOP PLATE (e), (f)	2x BOTTOM PLATE ATTACHMENT TO WOOD BELOW (g), (i)	ANCHOR BOLT SILL PLATE ATTACHMENT TO CONCRETE BELOW (h)	CAPACITY (PLF) SEISMIC/WIND
W1	OSB	7/16 (f)	1 3/8	2x	2x OR 1 1/4" LSL	8d@6" O.C. EDGE 8d@12" O.C. FIELD	LTP4 @ 20" O.C. OR A35 @ 16" O.C.	(1) 16d @ 8" O.C.	5/8" @ 48" O.C.	242/339
W2	OSB	7/16 (f)	1 3/8	2x	2x OR 1 1/4" LSL	8d@4" O.C. EDGE 8d@12" O.C. FIELD	LTP4 @ 14" O.C. OR A35 @ 11" O.C.	(1) 16d @ 6" O.C.	5/8" @ 36" O.C.	353/495
W3	OSB	7/16 (f)	1 3/8	2x	2x OR 1 1/4" LSL	8d@3" O.C. EDGE 8d@12" O.C. FIELD	LTP4 @ 11" O.C. OR A35 @ 8" O.C.	(1) 16d @ 4" O.C.	5/8" @ 24" O.C.	456/637
W4 (a)	OSB	7/16 (f)	1 3/8	3x	3x OR 1 3/4" LSL	8d@2" O.C. EDGE 8d@12" O.C. FIELD	LTP4 @ 8" O.C. OR A35 @ 6" O.C.	(2) 16d @ 6" O.C.	5/8" @ 24" O.C.	595/832

- (a) FRAMING AT ADJACENT PANELS SHALL BE 3" NOMINAL OR GREATER AND NAILS SHALL BE STAGGERED.
 (b) WHERE SHEATHING IS APPLIED ON BOTH SIDES OF WALL, PANEL EDGE JOINTS ON 2x FRAMING SHALL BE STAGGERED SO THAT JOINTS ON THE OPPOSITE SIDE ARE NOT LOCATED ON THE SAME STUDS.
 (c) BLOCKING IS REQUIRED AT ALL PANEL EDGES
 (d) PROVIDE SHEAR WALL SHEATHING AND NAILING FOR THE ENTIRE LENGTH OF THE WALLS INDICATED ON THE PLANS. ENDS OF FULL HEIGHT WALLS ARE DESIGNATED BY EXTERIOR OF THE BUILDING, CORRIDORS, WINDOW, OR DOORWAYS OR AS DESIGNATED ON THE PLANS. SEE PLANS FOR HOLD DOWN POSTS. SHEATHING EDGE NAILING IS REQUIRED AT ALL HOLD DOWN POSTS. EDGE NAILING MAY ALSO BE REQUIRED TO EACH STUD USED IN BUILT-UP HOLD DOWN POSTS.
 (e) BASED ON 0.131x 1 1/4" LONG NAILS USED TO ATTACH FRAMING CLIPS DIRECTLY TO FRAMING. USE 0.131x 2 1/2" NAILS WHERE INSTALLED OVER SHEATHING. USE A35 OR RBC CLIPS IN LIEU OF LTP'S FOR ROOF BLOCKING TO TOP PLATE.
 (f) LTP'S ARE NOT REQUIRED WHERE THE LOWER WALL SHEATHING IS OVERLAPPED ONTO THE RIM JOIST A MINIMUM OF 1 1/2" AND NAILED TO THE RIM JOIST PER THE SHEAR WALL PERIMETER NAIL SPACING. LTP4'S MAY BE SUBSTITUTED W/ A35'S.
 (g) CONTINUOUS SHEATHING IS REQUIRED OVER THE BOTTOM PLATE TO THE BOTTOM OF THE RIM JOIST OR SILL PLATE WITH EDGE NAILING AT EACH. WHERE TWO ROWS OF NAILING ARE REQUIRED AT RAISED FLOORS, PROVIDE BLOCKING PER PLAN, AND ATTACH WITH LTP4 PER SCHEDULE.
 (h) ANCHOR BOLTS SHALL BE PROVIDED WITH STEEL PLATE WASHERS 0.229"x3"x3". EMBED ANCHOR BOLTS MINIMUM 7" INTO THE CONCRETE. PLATE WASHERS SHALL EXTEND TO WITHIN 1/2" OF THE SILL PLATE EDGE ON THE SHEATHED WALL FACE.
 (i) PRESSURE TREATED MATERIALS CAN CAUSE EXCESSIVE CORROSION IN THE FASTENERS. PROVIDE HOT-DIPPED GALVANIZED (ELECTROPLATING IS NOT ACCEPTABLE) NAILS AND CONNECTOR PLATES (FRAMING ANGLES, ETC.) FOR ALL CONNECTORS IN CONTACT WITH PRESSURE TREATED FRAMING MEMBERS.
 (j) ALL SHEAR WALL STUDS MUST BE SPACED NO MORE THAN 16" O.C.
 (k) 3x MEMBERS MAY BE SUBSTITUTED WITH 2 STUDS NAILED TOGETHER PER TYPICAL BUILT-UP COLUMN DETAIL (SEE DETAILS).

**EAST TOWN CROSSING
BUILDING "F"**
PIONEER & SHAW PUYALLUP WA

REVISIONS

01	---
----	-----

REVISIONS

DRAWN BY:	CP
CHECKED BY:	CP
DATE:	2024.02.28
TITLE:	SHEAR WALL PLAN
PROJECT #:	---
SHEET:	


S3.7



PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
378 N. BENNETT ST.
TACOMA, WA 98407

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE DESIGN DETAILS OF
THE STRUCTURE ARE THE PROPERTY OF
PIERUCCIONI E&C, LLC AND ARE NOT TO BE
REPRODUCED IN WHOLE OR IN PART WITHOUT THE
WRITTEN AUTHORIZATION OF PIERUCCIONI E&C, LLC

EAST TOWN CROSSING
BUILDING "F"
PIONEER & SHAW PUYALLUP WA

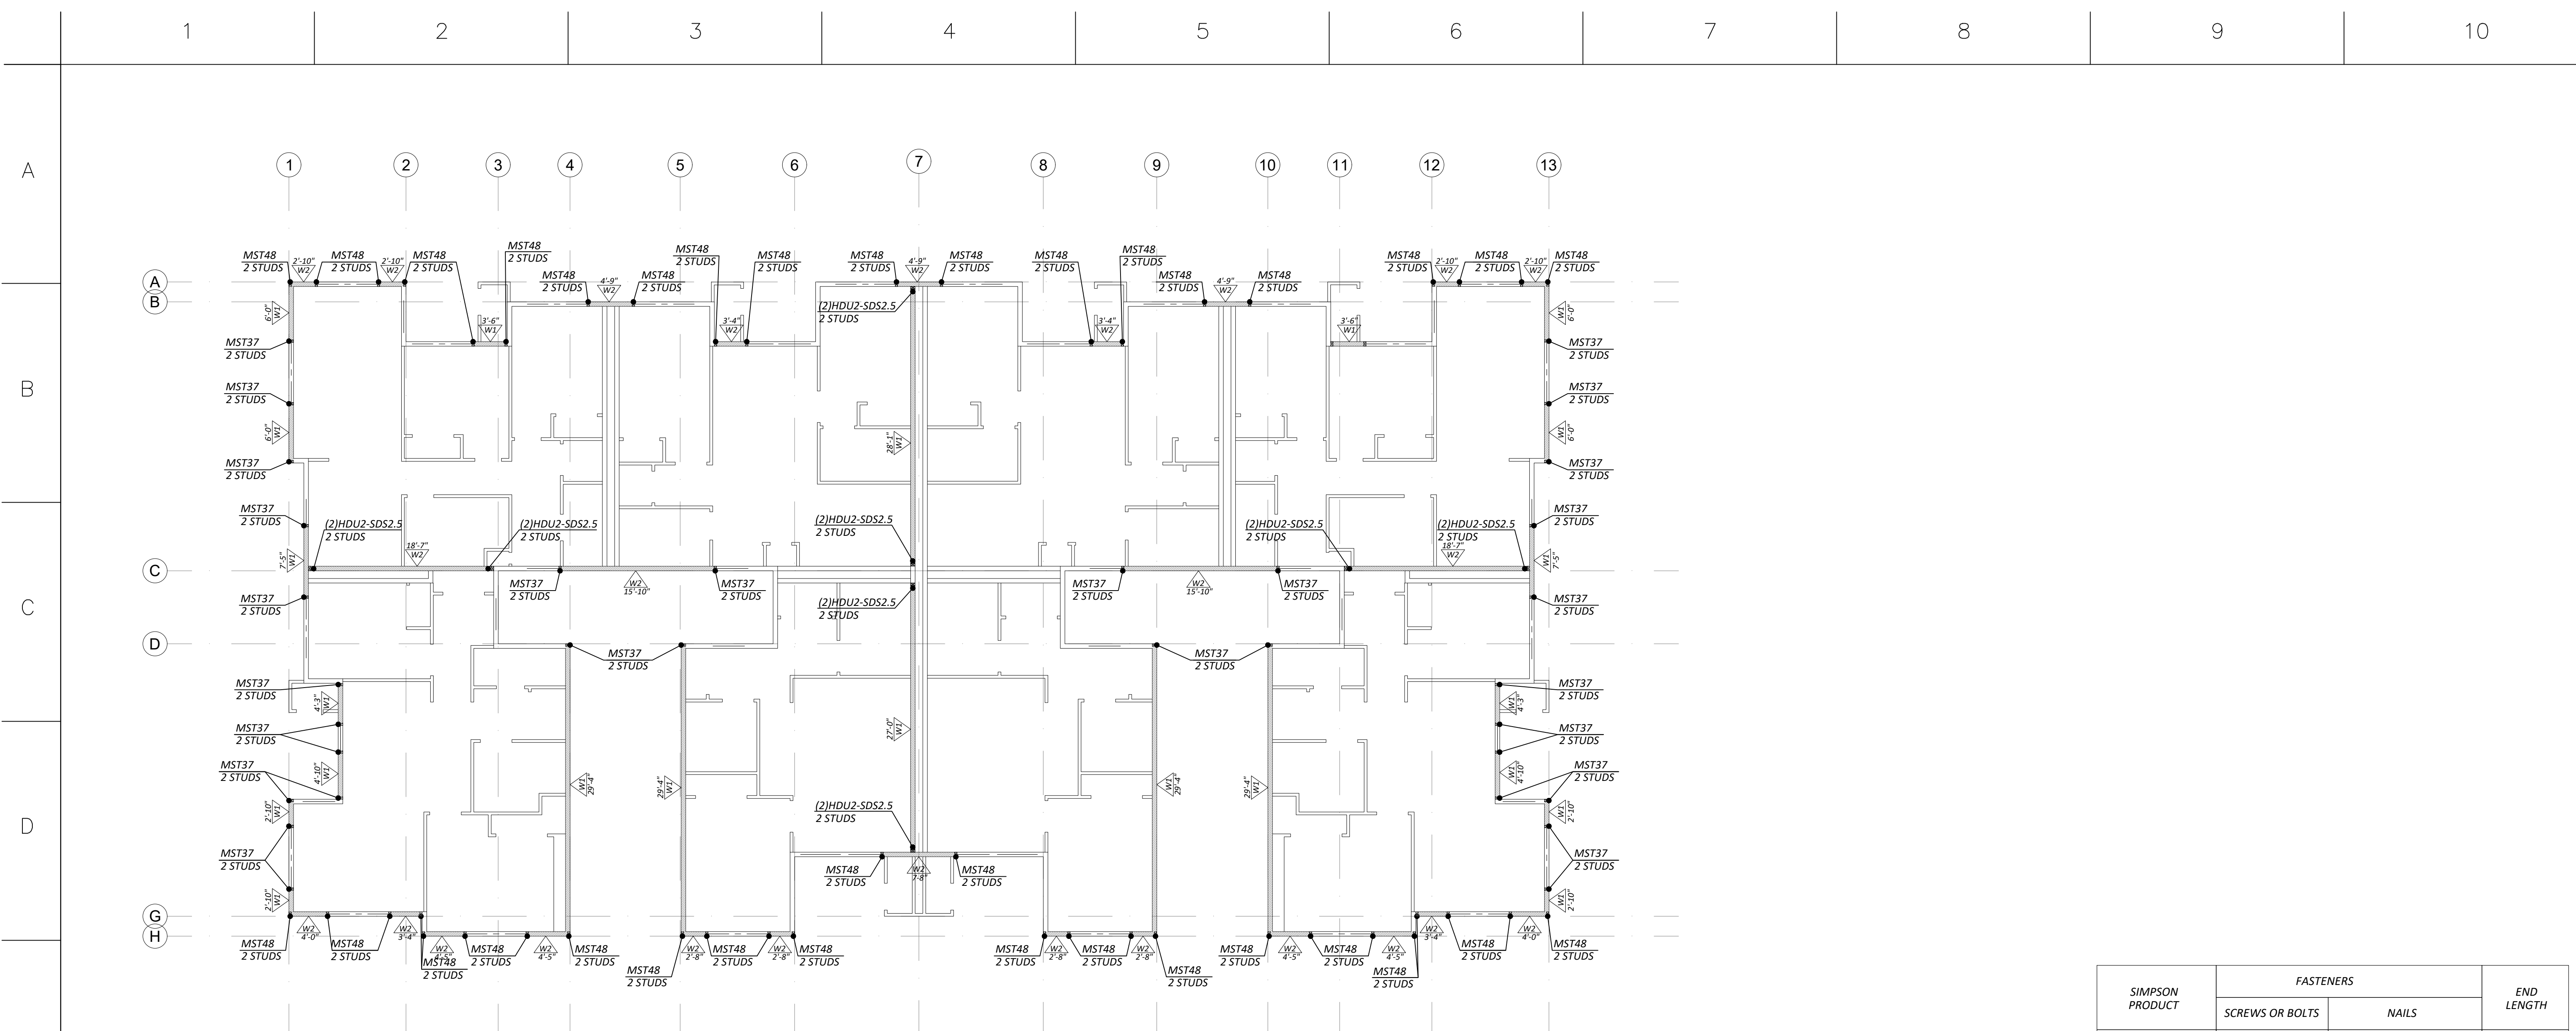

LEVEL 3 SHEAR WALL PLAN
1/8" = 1'-0"

- NOTES:
1. ALL EXTERIOR WALL SHALL BE SHEAR WALL TYPE W1 UNLESS NOTED OTHERWISE.

**SPECIAL INSPECTIONS ARE
REQUIRED FOR SHEAR
WALLS:**

SIMPSON PRODUCT	FASTENERS		END LENGTH
	SCREWS OR BOLTS	NAILS	
MST37	--	(22) 16d INTO 2 STUDS	--
MST48	--	(34) 16d INTO 2 STUDS	--

THRU FLOOR HOLD DOWN SCHEDULE

SIMPSON PRODUCT	FASTENERS		ANCHOR BOLTS
	SCREWS OR BOLTS	NAILS	
(2) HDU2-SDS2.5 (a)	(6) 1/4" X 2 1/2" SDS INTO POST PER PLAN	--	3/8" TREADED ROD
(2) HDU4-SDS2.5 (a)	(10) 1/4" X 2 1/2" SDS INTO POST PER PLAN	--	3/8" TREADED ROD

(a) THESE HOLD DOWNS ARE THRU FLOOR HOLD DOWN. TOTAL OF 2 HOLD DOWNS ARE REQUIRED (SEE DETAIL 2/S4.2).

SHEAR WALL AND ANCHOR TABLE

WALL TYPE	APA RATED SHEATHING (b), (c)	MINIMUM NOMINAL THICKNESS (IN) (j)	MINIMUM NAIL PENETRATION IN FRAMING (IN) (i)	STUD & BLOCKING SIZE @ ADJOINING EDGES (k)	REQUIRED RIM JOIST THICKNESS	EDGE NAIL SIZE AND SPACING, COMMON OR GALV. BOX (d)	RIM JOIST OR BLOCK CONNECTION TO TOP PLATE (e), (f)	2x BOTTOM PLATE ATTACHMENT TO WOOD BELOW (g), (i)	ANCHOR BOLT SILL PLATE ATTACHMENT TO CONCRETE BELOW (h)	CAPACITY (PL) SEISMIC/WIND
W1	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/4" LSL	8d@6" O.C. EDGE 8d@12" O.C. FIELD	LTP4 @ 20" O.C. OR A35 @ 16" O.C.	(1) 16d @ 8" O.C.	3/8" @ 48" O.C.	242/339
W2	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/4" LSL	8d@4" O.C. EDGE 8d@12" O.C. FIELD	LTP4 @ 14" O.C. OR A35 @ 11" O.C.	(1) 16d @ 6" O.C.	3/8" @ 36" O.C.	353/495

- (a) FRAMING AT ADJACENT PANELS SHALL BE 3" NOMINAL OR GREATER AND NAILS SHALL BE STAGGERED.
 (b) WHERE SHEATHING IS APPLIED ON BOTH SIDES OF WALL, PANEL EDGE JOINTS ON 2x FRAMING SHALL BE STAGGERED SO THAT JOINTS ON THE OPPOSITE SIDE ARE NOT LOCATED ON THE SAME STUDS.
 (c) BLOCKING IS REQUIRED AT ALL PANEL EDGES
 (d) PROVIDE SHEAR WALL SHEATHING AND NAILING FOR THE ENTIRE LENGTH OF THE WALLS INDICATED ON THE PLANS. ENDS OF FULL HEIGHT WALLS ARE DESIGNATED BY EXTERIOR OF THE BUILDING, CORRIDORS, WINDOW, OR DOORWAYS OR AS DESIGNATED ON THE PLANS. SEE PLANS FOR HOLD DOWN POSTS. SHEATHING EDGE NAILING IS REQUIRED AT ALL HOLD DOWN POSTS. EDGE NAILING MAY ALSO BE REQUIRED TO EACH STUD USED IN BUILT-UP HOLD DOWN POSTS.
 (e) BASED ON 0.131x 1 1/4" LONG NAILS USED TO ATTACH FRAMING CLIPS DIRECTLY TO FRAMING. USE 0.131x 2 1/2" NAILS WHERE INSTALLED OVER SHEATHING. USE A35 OR RBC CLIPS IN LIEU OF LTP'S FOR ROOF BLOCKING TO TOP PLATE.
 (f) LTP'S ARE NOT REQUIRED WHERE THE LOWER WALL SHEATHING IS OVERLAPPED ONTO THE RIM JOIST A MINIMUM OF 1 1/2" AND NAILED TO THE RIM JOIST PER THE SHEAR WALL PERIMETER NAIL SPACING. LTP'S MAY BE SUBSTITUTED W/ A35'S.
 (g) CONTINUOUS SHEATHING IS REQUIRED OVER THE BOTTOM PLATE TO THE BOTTOM OF THE RIM JOIST OR SILL PLATE WITH EDGE NAILING AT EACH. WHERE TWO ROWS OF NAILING ARE REQUIRED AT RAISED FLOORS, PROVIDE BLOCKING PER PLAN, AND ATTACH WITH LTP4 PER SCHEDULE.
 (h) ANCHOR BOLTS SHALL BE PROVIDED WITH STEEL PLATE WASHERS 0.229"x3"x3". EMBED ANCHOR BOLTS MINIMUM 7" INTO THE CONCRETE. PLATE WASHERS SHALL EXTEND TO WITHIN 1/2" OF THE SILL PLATE EDGE ON THE SHEATHED WALL FACE.
 (i) PRESSURE TREATED MATERIALS CAN CAUSE EXCESSIVE CORROSION IN THE FASTENERS. PROVIDE HOT-DIPPED GALVANIZED (ELECTROPLATING IS NOT ACCEPTABLE) NAILS AND CONNECTOR PLATES (FRAMING ANGLES, ETC.) FOR ALL CONNECTORS IN CONTACT WITH PRESSURE TREATED FRAMING MEMBERS.
 (j) ALL SHEAR WALL STUDS MUST BE SPACED NO MORE THAN 16" O.C.
 (k) 3X MEMBERS MAY BE SUBSTITUTED WITH 2 STUDS NAILED TOGETHER PER TYPICAL BUILT-UP COLUMN DETAIL (SEE DETAILS).

REVISIONS

01

REVISIONS

DRAWN BY: CP

CHECKED BY: CP

DATE: 2024.02.28

TITLE: SHEAR WALL PLAN

PROJECT #: ---

SHEET:


S3.8



PIERUCCI E&C, LLC
CHON PIERUCCI, PE
3728 N. BENNETT ST.
TACOMA, WA 98407

REUSE OF DOCUMENTS
THIS DOCUMENT IS THE PROPERTY OF
PIERUCCI E&C, LLC. IT IS TO BE USED
ONLY FOR THE PROJECT AND SITE SPECIFICALLY
IDENTIFIED HEREON. ANY REUSE OF THIS
DOCUMENT FOR ANY OTHER PROJECT WITHOUT
THE WRITTEN PERMISSION OF PIERUCCI E&C, LLC
IS PROHIBITED.

EAST TOWN CROSSING
BUILDING "F"
PIONEER & SHAW PUYALLUP WA

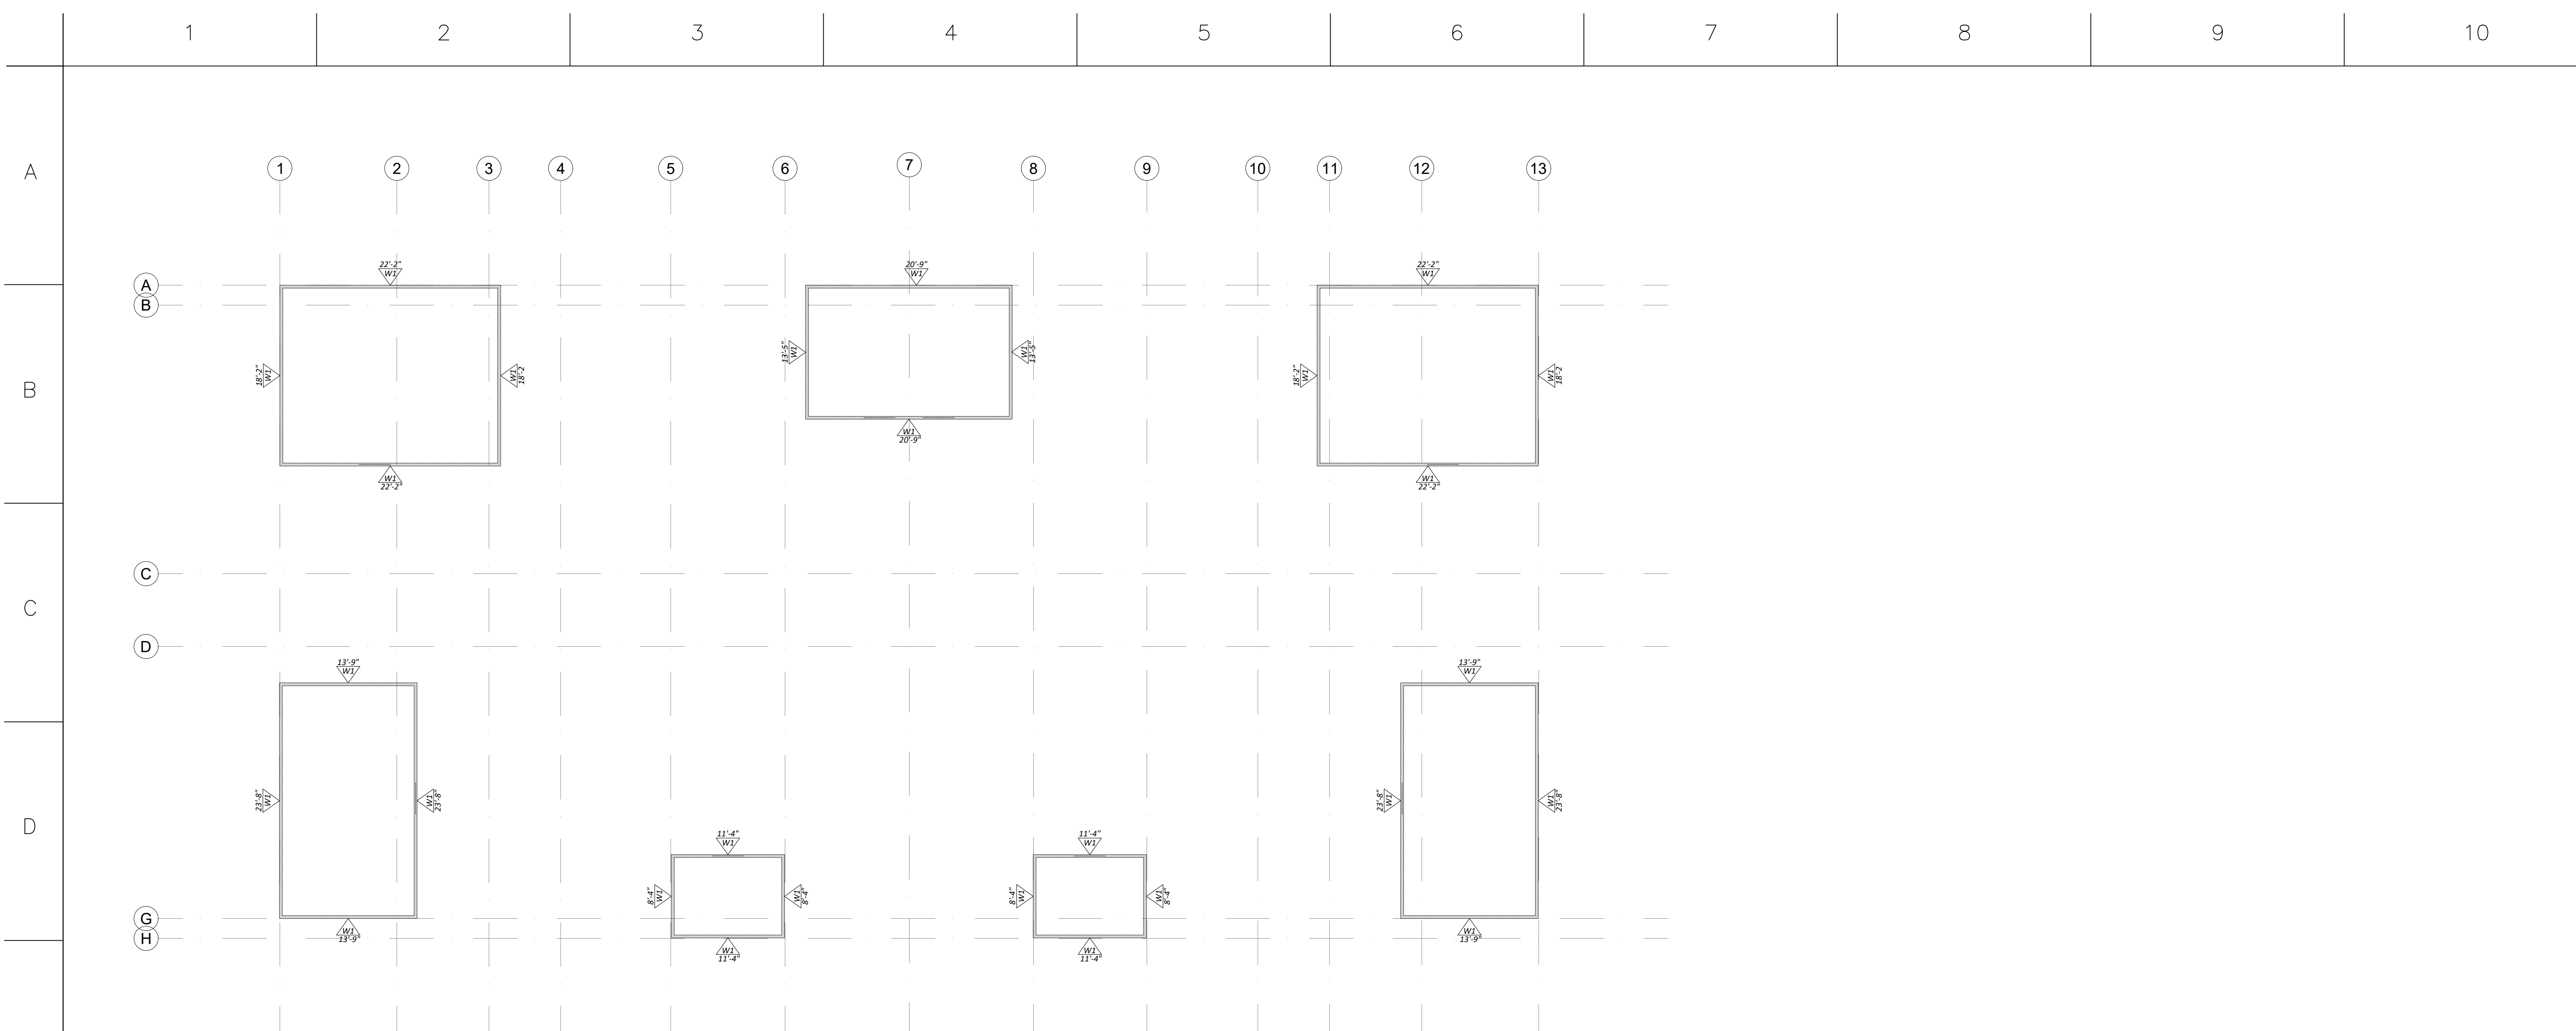

UPPER ROOF SHEAR WALL PLAN
1/8" = 1'-0"

- NOTES:
1. ALL EXTERIOR WALL SHALL BE SHEAR WALL TYPE W1 UNLESS NOTED OTHERWISE.

SHEAR WALL AND ANCHOR TABLE

WALL TYPE	APA RATED SHEATHING (b), (c)	MINIMUM NOMINAL THICKNESS (IN) (f)	MINIMUM NAIL PENETRATION IN FRAMING (IN) (i)	STUD & BLOCKING SIZE @ ADJOINING EDGES (k)	REQUIRED RIM JOIST THICKNESS	EDGE NAIL SIZE AND SPACING, COMMON OR GALV. BOX (d)	RIM JOIST OR BLOCK CONNECTION TO TOP PLATE (e), (f)	2x BOTTOM PLATE ATTACHMENT TO WOOD BELOW (g), (i)	ANCHOR BOLT SILL PLATE ATTACHMENT TO CONCRETE BELOW (h)	CAPACITY (PLF) SEISMIC/WIND
W1	OSB	7/16 (f)	1 3/8	2x	2x OR 1 1/4" LSL	8d@6" O.C. EDGE 8d@12" O.C. FIELD	LTP4 @ 20" O.C. OR A35 @ 16" O.C.	(1) 16d @ 8" O.C.	3/8" @ 48" O.C.	242/339

- (a) FRAMING AT ADJACENT PANELS SHALL BE 3" NOMINAL OR GREATER AND NAILS SHALL BE STAGGERED.
(b) WHERE SHEATHING IS APPLIED ON BOTH SIDES OF WALL, PANEL EDGE JOINTS ON 2x FRAMING SHALL BE STAGGERED SO THAT JOINTS ON THE OPPOSITE SIDE ARE NOT LOCATED ON THE SAME STUDS.
(c) BLOCKING IS REQUIRED AT ALL PANEL EDGES
(d) PROVIDE SHEAR WALL SHEATHING AND NAILING FOR THE ENTIRE LENGTH OF THE WALLS INDICATED ON THE PLANS. ENDS OF FULL HEIGHT WALLS ARE DESIGNATED BY EXTERIOR OF THE BUILDING, CORRIDORS, WINDOW, OR DOORWAYS OR AS DESIGNATED ON THE PLANS. SEE PLANS FOR HOLD DOWN POSTS. SHEATHING EDGE NAILING IS REQUIRED AT ALL HOLD DOWN POSTS. EDGE NAILING MAY ALSO BE REQUIRED TO EACH STUD USED IN BUILT-UP HOLD DOWN POSTS.
(e) BASED ON 0.131x 1 1/4" LONG NAILS USED TO ATTACH FRAMING CLIPS DIRECTLY TO FRAMING. USE 0.131x 2 1/2" NAILS WHERE INSTALLED OVER SHEATHING. USE A35 OR RBC CLIPS IN LIEU OF LTP'S FOR ROOF BLOCKING TO TOP PLATE.
(f) LTP4'S ARE NOT REQUIRED WHERE THE LOWER WALL SHEATHING IS OVERLAPPED ONTO THE RIM JOIST A MINIMUM OF 1 1/2" AND NAILED TO THE RIM JOIST PER THE SHEAR WALL PERIMETER NAIL SPACING. LTP4'S MAY BE SUBSTITUTED W/ A35'S.
(g) CONTINUOUS SHEATHING IS REQUIRED OVER THE BOTTOM PLATE TO THE BOTTOM OF THE RIM JOIST OR SILL PLATE WITH EDGE NAILING AT EACH. WHERE TWO ROWS OF NAILING ARE REQUIRED AT RAISED FLOORS, PROVIDE BLOCKING PER PLAN, AND ATTACH WITH LTP4 PER SCHEDULE.
(h) ANCHOR BOLTS SHALL BE PROVIDED WITH STEEL PLATE WASHERS 0.229"x3"x3". EMBED ANCHOR BOLTS MINIMUM 7" INTO THE CONCRETE. PLATE WASHERS SHALL EXTEND TO WITHIN 1/2" OF THE SILL PLATE EDGE ON THE SHEATHED WALL FACE.
(i) PRESSURE TREATED MATERIALS CAN CAUSE EXCESSIVE CORROSION IN THE FASTENERS. PROVIDE HOT-DIPPED GALVANIZED (ELECTROPLATING IS NOT ACCEPTABLE) NAILS AND CONNECTOR PLATES (FRAMING ANGLES, ETC.) FOR ALL CONNECTORS IN CONTACT WITH PRESSURE TREATED FRAMING MEMBERS.
(j) ALL SHEAR WALL STUDS MUST BE SPACED NO MORE THAN 16" O.C.
(k) 3x MEMBERS MAY BE SUBSTITUTED WITH 2 STUDS NAILED TOGETHER PER TYPICAL BUILT-UP COLUMN DETAIL (SEE DETAILS).

REVISIONS

01	---
----	-----

REVISIONS

DRAWN BY:	CP
CHECKED BY:	CP
DATE:	2024.02.28
TITLE:	SHEAR WALL PLAN
PROJECT #:	---
SHEET:	

S3.9



PIERUCCI E&C, LLC
CHON PIERUCCI, PE
378 N. BENNETT ST.
TACOMA, WA 98407

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE DESIGNATIONS OF PROFESSIONAL LICENSE ARE THE PROPERTY OF PIERUCCI E&C, LLC AND ARE NOT TO BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN APPROVAL OF PIERUCCI E&C, LLC.

EAST TOWN CROSSING
BUILDING "F"
PIONEER & SHAW PUYALLUP WA

REVISIONS

01	---
----	-----

REVISIONS

DRAWN BY: CP

CHECKED BY: CP


DATE: 2024.02.28

TITLE: FOUNDATION DETAILS

PROJECT #: ---

SHEET:

S4.1

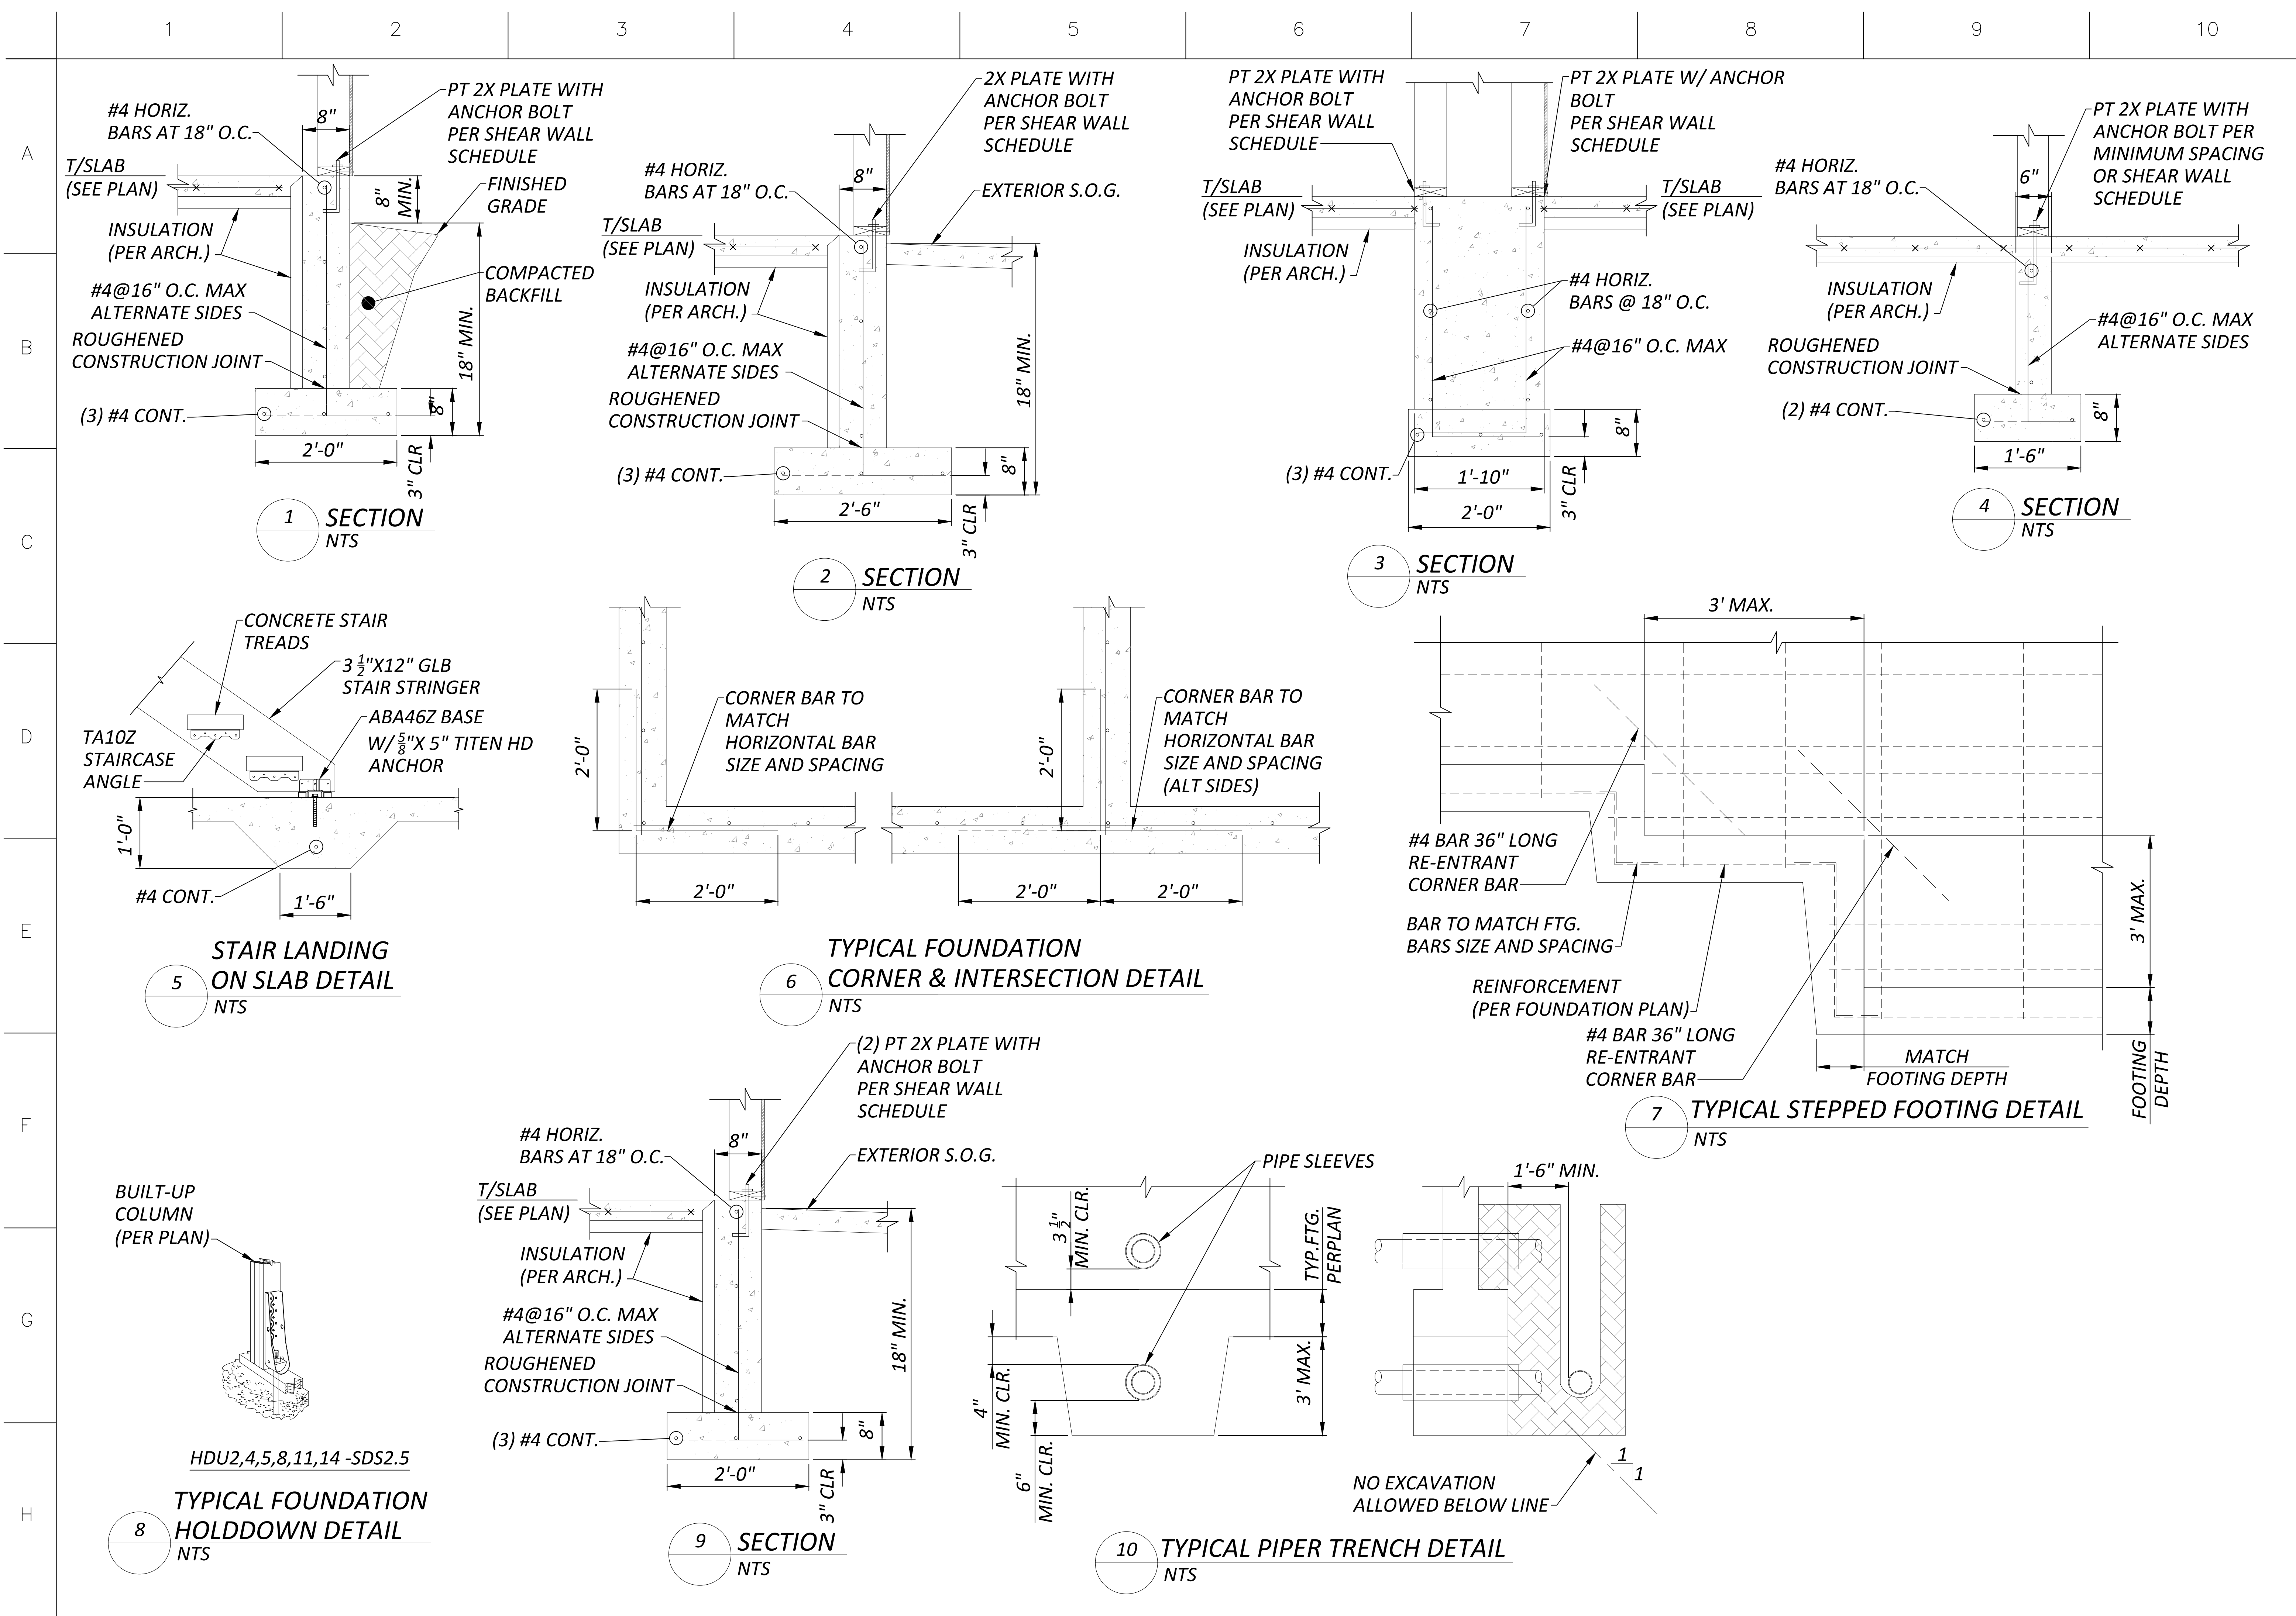



PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
378 N. BENNETT ST.
TACOMA, WA 98407

RELEASE OF DOCUMENTS
THIS DOCUMENT IS THE SOLE PROPERTY OF
PROFESSIONAL ENGINEER CHON PIERUCCIONI, PE.
IT IS TO BE USED ONLY FOR THE PROJECT AND
SPECIFICALLY IDENTIFIED IN THE TITLE BLOCK.
REPRODUCTION IN WHOLE OR IN PART WITHOUT THE
WRITTEN AUTHORIZATION OF PIERUCCIONI E&C, LLC

EAST TOWN CROSSING
BUILDING "F"
PIONEER & SHAW PUYALLUP WA

REVISIONS

01	---
----	-----

REVISIONS

DRAWN BY:	CP
-----------	----

CHECKED BY:	CP
-------------	----


DATE:	2024.02.28
-------	------------

TITLE:	FRAMING DETAILS
--------	-----------------

PROJECT #:	---
------------	-----

SHEET:	---
--------	-----

S4.2

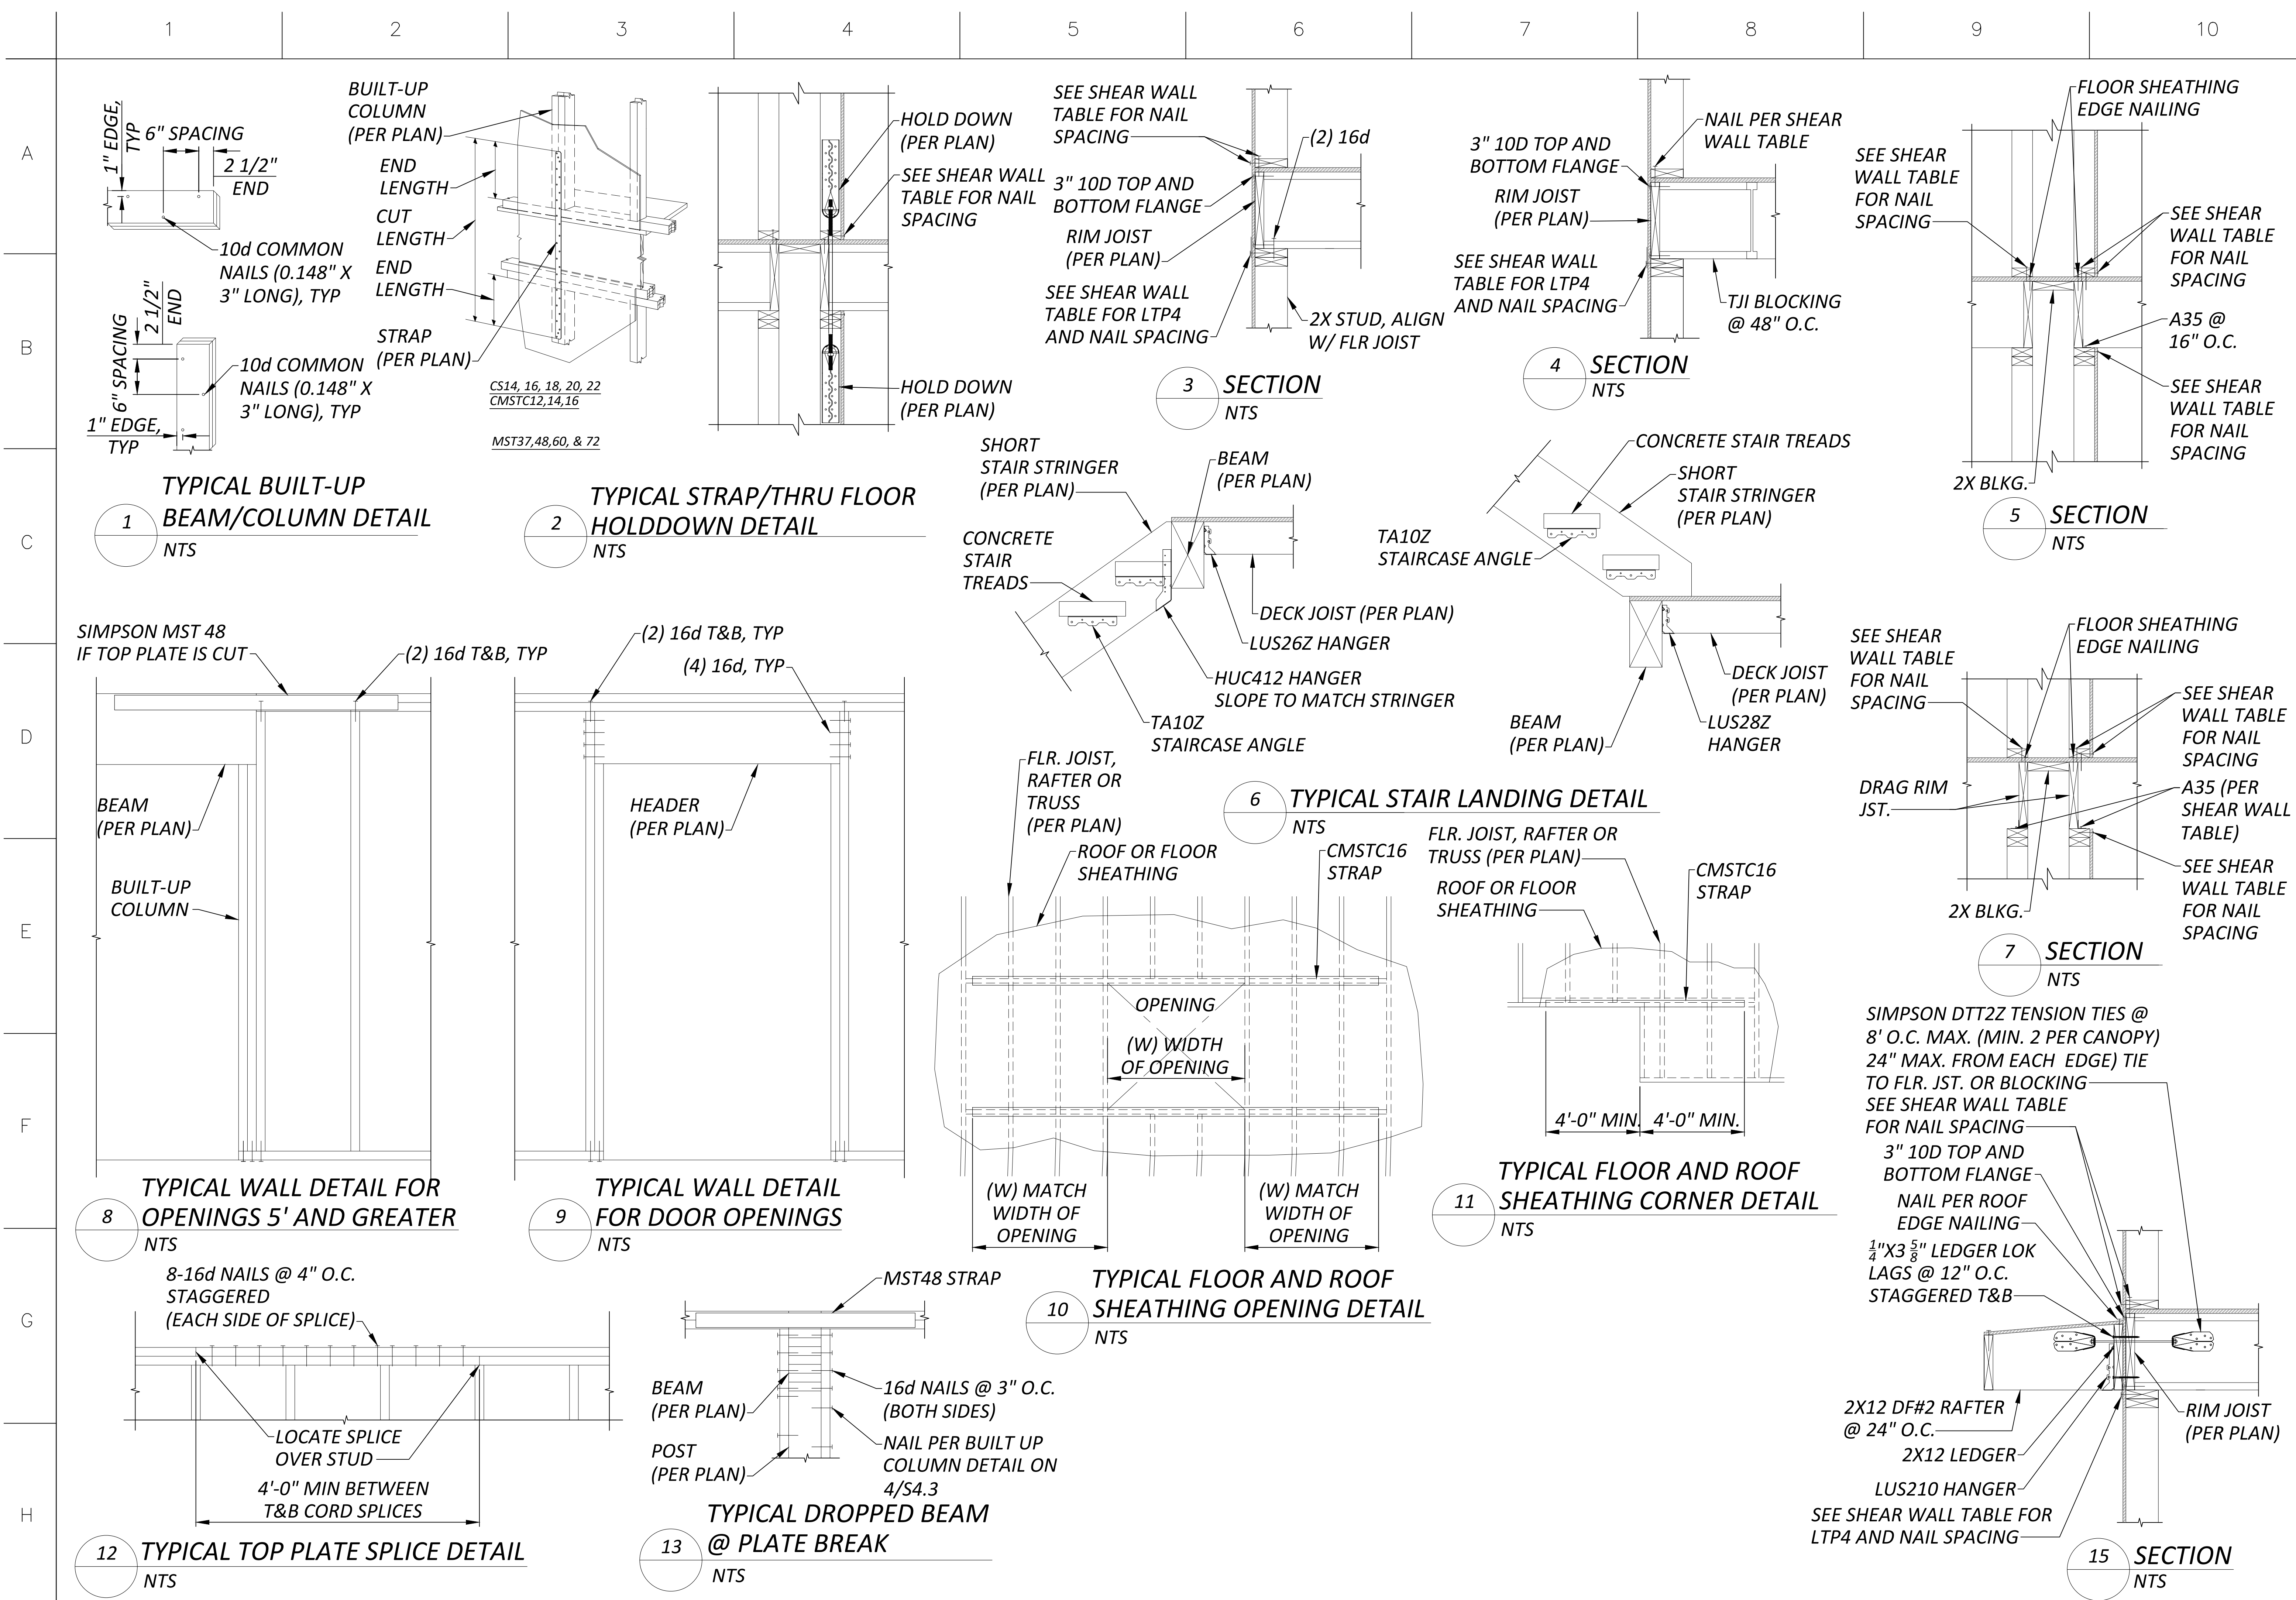

ENERGY CODE NOTES

WASHINGTON STATE COMMISSIONING REQUIREMENTS

C408.1.1 CONSTRUCTION DOCUMENTS SHALL CLEARLY INDICATE PROVISIONS FOR COMMISSIONING PROCESS. THE CONSTRUCTION DOCUMENTS SHALL MINIMALLY INCLUDE THE FOLLOWING:

1. A NARRATIVE DESCRIPTION OF THE ACTIVITIES THAT WILL BE ACCOMPLISHED DURING THE COMMISSIONING PROCESS. AT A MINIMUM, THE COMMISSIONING PROCESS IS REQUIRED TO INCLUDE:
 - 1.1. DEVELOPMENT AND EXECUTION OF THE COMMISSIONING PLAN, INCLUDING ALL SUBSECTIONS OF SECTION C408.1.2;
 - 1.2. THE CERTIFIED COMMISSIONING PROFESSIONAL'S REVIEW OF THE BUILDING DOCUMENTATION AND CLOSE OUT SUBMITTALS IN ACCORDANCE WITH SECTION C103.6; AND
 - 1.3. THE COMMISSIONING REPORT IN ACCORDANCE WITH SECTION C408.1.3.
2. ROLES, RESPONSIBILITIES AND REQUIRED QUALIFICATIONS OF THE CERTIFIED COMMISSIONING PROFESSIONAL.
3. A LISTING OF THE SPECIFIC EQUIPMENT, APPLIANCES OR SYSTEMS TO BE TESTED.

C408.1.2 A COMMISSIONING PLAN SHALL BE DEVELOPED BY THE PROJECT'S CERTIFIED COMMISSIONING PROFESSIONAL AND SHALL OUTLINE THE ORGANIZATION, SCHEDULE, ALLOCATION OF RESOURCES, AND DOCUMENTATION REQUIREMENTS OF THE COMMISSIONING PROCESS. THE PLAN SHALL ALSO INCLUDE THE FOLLOWING:

1. A NARRATIVE DESCRIPTION OF THE ACTIVITIES THAT WILL BE ACCOMPLISHED DURING EACH PHASE OF COMMISSIONING, INCLUDING THE PERSONNEL INTENDED TO ACCOMPLISH EACH OF THE ACTIVITIES, SYSTEMS TESTING AND BALANCING, FUNCTIONAL PERFORMANCE TESTING, AND VERIFICATION OF THE BUILDING DOCUMENTATION REQUIREMENTS IN SECTION C103.6.
2. ROLES AND RESPONSIBILITIES OF THE COMMISSIONING TEAM, INCLUDING THE NAME AND STATEMENT OF QUALIFICATIONS OF THE CERTIFIED COMMISSIONING PROFESSIONAL.
3. A LISTING OF THE SPECIFIC EQUIPMENT, APPLIANCES OR SYSTEMS TO BE TESTED AND A DESCRIPTION OF THE TESTS TO BE PERFORMED.

C408.1.2.1 WHERE THE CERTIFIED COMMISSIONING PROFESSIONAL'S CONTRACT OR EMPLOYMENT IS OTHER THAN DIRECTLY WITH THE BUILDING OWNER, AN IN-HOUSE COMMISSIONING DISCLOSURE AND CONFLICT MANAGEMENT PLAN SHALL BE A PART OF THE COMMISSIONING PROCESS. A COPY SHALL BE INCLUDED IN THE COMMISSIONING PLAN. THIS PLAN SHALL DISCLOSE THE CERTIFIED COMMISSIONING PROFESSIONAL'S CONTRACTUAL RELATIONSHIP WITH OTHER TEAM MEMBERS AND PROVIDE A CONFLICT MANAGEMENT PLAN DEMONSTRATING THAT THE CERTIFIED COMMISSIONING PROFESSIONAL IS FREE TO IDENTIFY ANY ISSUES DISCOVERED AND REPORT DIRECTLY TO THE OWNER.

C408.1.2.2 FUNCTIONAL PERFORMANCE TESTING SHALL BE CONDUCTED FOR MECHANICAL SYSTEMS IN SECTIONS C403; SERVICE WATER HEATING SYSTEMS IN SECTION C404; CONTROLLED RECEPTACLES AND LIGHTING CONTROL SYSTEMS IN SECTION C405; EQUIPMENT, APPLIANCES AND SYSTEMS INSTALLED TO COMPLY WITH SECTION C406 OR C407; ENERGY METERING IN SECTION C409; AND REFRIGERATION SYSTEMS IN SECTION C410. WRITTEN PROCEDURES WHICH CLEARLY DESCRIBE THE INDIVIDUAL SYSTEMATIC TEST PROCEDURES, THE EXPECTED SYSTEM RESPONSE OR ACCEPTANCE CRITERIA FOR EACH PROCEDURE, THE ACTUAL RESPONSE OR FINDINGS, AND ANY PERTINENT DISCUSSION SHALL BE FOLLOWED. THIS TESTING SHALL INCLUDE CONTROL SYSTEMS WHICH WILL BE TESTED TO DOCUMENT THAT CONTROL DEVICES, COMPONENTS, EQUIPMENT, AND SYSTEMS ARE CALIBRATED AND ADJUSTED TO OPERATE IN ACCORDANCE WITH APPROVED CONSTRUCTION DOCUMENTS. TESTING SHALL AFFIRM THE CONDITIONS REQUIRED WITHIN SECTIONS C408.2 THROUGH C408.7 UNDER SYSTEM TESTING.

C408.1.2.3 FOR PROJECTS WITH SEVEN OR FEWER SIMILAR SYSTEMS, EACH SYSTEM SHALL BE TESTED. FOR PROJECTS WITH MORE THAN SEVEN SYSTEMS, TESTING SHALL BE DONE FOR EACH UNIQUE COMBINATION OF CONTROLS TYPE, WHERE MULTIPLES OF EACH UNIQUE COMBINATION OF CONTROL TYPES EXIST, NO FEWER THAN 20 PERCENT OF EACH COMBINATION SHALL BE TESTED UNLESS THE CODE OFFICIAL OR DESIGN PROFESSIONAL REQUIRES A HIGHER PERCENTAGE TO BE TESTED. WHERE 30 PERCENT OR MORE OF THE TESTED SYSTEM FAIL, ALL REMAINING IDENTICAL COMBINATIONS SHALL BE TESTED.

C408.1.2.4 DEFICIENCIES FOUND DURING TESTING SHALL BE RESOLVED INCLUDING CORRECTIONS AND RETESTING.

C408.1.3 A FINAL COMMISSIONING REPORT SHALL BE COMPLETED AND CERTIFIED BY THE CERTIFIED COMMISSIONING PROFESSIONAL AND DELIVERED TO THE BUILDING OWNER OR OWNER'S AUTHORIZED AGENT. THE REPORT SHALL BE ORGANIZED WITH MECHANICAL, SERVICE WATER HEATING, CONTROLLED RECEPTACLE AND LIGHTING CONTROL SYSTEMS, ENERGY METERING, AND REFRIGERATION FINDINGS IN SEPARATE SECTIONS TO ALLOW INDEPENDENT REVIEW. THE REPORT SHALL RECORD THE ACTIVITIES AND RESULTS OF THE COMMISSIONING PROCESS AND BE DEVELOPED FROM THE FINAL COMMISSIONING PLAN WITH ALL OF ITS ATTACHED APPENDICES. THE REPORT SHALL INCLUDE:

1. RESULTS OF FUNCTIONAL PERFORMANCE TESTS.
2. DISPOSITION OF DEFICIENCIES FOUND DURING TESTING, INCLUDING DETAILS OF CORRECTIVE MEASURES USED OR PROPOSED.
3. FUNCTIONAL PERFORMANCE TEST PROCEDURES USED DURING THE COMMISSIONING PROCESS INCLUDING MEASURABLE CRITERIA FOR TEST ACCEPTANCE, PROVIDED HEREIN FOR REPEATABILITY.
4. COMMISSIONING PLAN.
5. TESTING, ADJUSTING AND BALANCING REPORT. EXCEPTION: DEFERRED TESTS WHICH CANNOT BE PERFORMED AT THE TIME OF REPORT PREPARATION DUE TO CLIMATIC CONDITIONS.

C408.1.4 PRIOR TO THE FINAL MECHANICAL, PLUMBING AND ELECTRICAL INSPECTIONS OR OBTAINING A CERTIFICATE OF OCCUPANCY, THE CERTIFIED COMMISSIONING PROFESSIONAL SHALL PROVIDE EVIDENCE OF BUILDING COMMISSIONING IN ACCORDANCE WITH THE PROVISIONS OF THIS SECTION.

C408.1.4.1 BUILDINGS, OR PORTIONS THEREOF, SHALL NOT BE CONSIDERED ACCEPTABLE FOR A FINAL INSPECTION PURSUANT TO SECTION C104.2.6 UNTIL THE CODE OFFICIAL HAS RECEIVED A LETTER OF TRANSMITTAL FROM THE BUILDING OWNER OR OWNER'S REPRESENTATIVE ACKNOWLEDGING THAT THE BUILDING OWNER OR OWNER'S AUTHORIZED AGENT HAS RECEIVED THE COMMISSIONING REPORT. COMPLETION OF COMMISSIONING COMPLIANCE CHECKLIST (FIGURE C408.1.4.1) IS DEEMED TO SATISFY THIS REQUIREMENT. PHASED ACCEPTANCE OF COMMISSIONING COMPLIANCE CHECKLIST FOR PORTIONS OF THE WORK SPECIFIC TO THE TRADE THAT IS BEING INSPECTED IS PERMISSIBLE WHERE ACCEPTED BY THE CODE OFFICIAL AND WHERE THE CERTIFIED COMMISSIONING PROFESSIONAL REMAINS RESPONSIBLE FOR COMPLETION OF THE COMMISSIONING PROCESS. IF THERE ARE UNRESOLVED DEFICIENCIES WHEN THE FINAL INSPECTION IS SCHEDULED, THE COMMISSIONING REPORT SHALL BE SUBMITTED AND SHALL DESCRIBE THE UNRESOLVED DEFICIENCIES.

C408.1.4.2 THE CODE OFFICIAL SHALL BE PERMITTED TO REQUIRE THAT A COPY OF THE COMMISSIONING REPORT BE MADE AVAILABLE FOR REVIEW BY THE CODE OFFICIAL.

C408.2 MECHANICAL EQUIPMENT AND CONTROLS SUBJECT TO SECTION C403 SHALL BE INCLUDED IN THE COMMISSIONING PROCESS REQUIRED BY SECTION C408.1. THE COMMISSIONING PROCESS SHALL MINIMALLY INCLUDE ALL ENERGY CODE REQUIREMENTS FOR WHICH THE CODE STATES THAT EQUIPMENT OR CONTROLS SHALL "BE CAPABLE OF" OR CONFIGURED TO PERFORM SPECIFIC FUNCTIONS. EXCEPTION: MECHANICAL SYSTEMS ARE EXEMPT FROM THE COMMISSIONING PROCESS WHERE THE INSTALLED TOTAL MECHANICAL EQUIPMENT CAPACITY IS LESS THAN 240,000 BTU/H COOLING CAPACITY AND LESS THAN 300,000 BTU/H HEATING CAPACITY.

C408.2.2 HVAC SYSTEMS SHALL BE BALANCED IN ACCORDANCE WITH GENERALLY ACCEPTED ENGINEERING STANDARDS. AIR AND WATER FLOW RATES SHALL BE MEASURED AND ADJUSTED TO DELIVER FINAL FLOW RATES WITHIN THE TOLERANCES PROVIDED IN THE PROJECT SPECIFICATIONS. TEST AND BALANCE ACTIVITIES SHALL INCLUDE AIR SYSTEM AND HYDRONIC SYSTEM BALANCING.

C408.2.2.1 EACH SUPPLY AIR OUTLET AND ZONE TERMINAL DEVICE SHALL BE EQUIPPED WITH MEANS FOR AIR BALANCING IN ACCORDANCE WITH THE REQUIREMENTS OF CHAPTER 6 OF THE INTERNATIONAL MECHANICAL CODE. DISCHARGE DAMPERS USED FOR AIR SYSTEM BALANCING ARE PROHIBITED ON CONSTANT VOLUME FANS AND VARIABLE VOLUME FANS WITH MOTORS 10 HP (18.6 KW) AND LARGER. AIR SYSTEMS SHALL BE BALANCED IN A MANNER TO FIRST

MINIMIZE THROTTLING LOSSES THEN, FOR FANS WITH SYSTEM POWER OF GREATER THAN 1 HP (0.74 KW), FAN SPEED SHALL BE ADJUSTED TO MEET DESIGN FLOW CONDITIONS. EXCEPTION: FANS WITH FAN MOTORS OF 1 HP (0.74 KW) OR LESS.

C408.2.2.2 INDIVIDUAL HYDRONIC HEATING AND COOLING COILS SHALL BE EQUIPPED WITH MEANS FOR BALANCING AND MEASURING FLOW. HYDRONIC SYSTEMS SHALL BE PROPORTIONATELY BALANCED IN A MANNER TO FIRST MINIMIZE THROTTLING LOSSES, THEN THE PUMP IMPELLER SHALL BE TRIMMED OR PUMP SPEED SHALL BE ADJUSTED TO MEET DESIGN FLOW CONDITIONS. EACH HYDRONIC SYSTEM SHALL HAVE EITHER THE CAPABILITY TO MEASURE PRESSURE ACROSS THE PUMP, OR TEST PORTS AT EACH SIDE OF EACH PUMP. EXCEPTION: THE FOLLOWING EQUIPMENT IS NOT REQUIRED TO BE EQUIPPED WITH MEANS FOR BALANCING OR MEASURING FLOW:

1. PUMPS WITH PUMP MOTORS OF 5 HP (3.7 KW) OR LESS.
2. WHERE THROTTLING RESULTS IN NO GREATER THAN FIVE PERCENT OF THE NAMEPLATE HORSEPOWER DRAW ABOVE THAT REQUIRED IF THE IMPELLER WERE TRIMMED.

C408.2.3 FUNCTIONAL PERFORMANCE TESTING SHALL DEMONSTRATE THE COMPONENTS, SYSTEMS, AND SYSTEM-TO-SYSTEM INTERFACING RELATIONSHIPS ARE INSTALLED AND OPERATE IN ACCORDANCE WITH APPROVED CONSTRUCTION DOCUMENTS. TESTING SHALL INCLUDE THE SEQUENCE OF OPERATION, AND BE CONDUCTED UNDER FULL-LOAD, OART-LOAD AND THE FOLLOWING CONDITIONS:

1. ALL MODES AS DESCRIBED IN THE SEQUENCE OF OPERATION;
2. REDUNDANT OR AUTOMATIC BACK-UP MODE;
3. PERFORMANCE OF ALARMS; AND
4. MODE OF OPERATION UPON LOSS OF POWER AND RESTORATION OF POWER.

C408.3 SERVICE WATER HEATING EQUIPMENT AND CONTROLS SUBJECT TO SECTION C404 SHALL BE INCLUDED IN THE COMMISSIONING PROCESS REQUIRED BY SECTION C408.1. THE COMMISSIONING PROCESS SHALL MINIMALLY INCLUDE EQUIPMENT AND COMPONENTS INSTALLED TO MEET ALL ENERGY CODE REQUIREMENTS FOR DEVICES TO "START," "AUTOMATICALLY TURN OFF," "AUTOMATICALLY ADJUST," "LIMIT OPERATION," AND "LIMIT THE TEMPERATURE" AND "BE CONFIGURED TO."

C408.4 CONTROLLED RECEPTACLES AND LIGHTING CONTROL SYSTEMS SUBJECT TO SECTION C405 SHALL BE INCLUDED IN THE COMMISSIONING PROCESS REQUIRED BY SECTION C408.1. THE CONFIGURATION AND FUNCTION OF CONTROLLED RECEPTACLES AND LIGHTING CONTROL SYSTEMS REQUIRED BY THIS CODE SHALL BE TESTED AND SHALL COMPLY WITH SECTION C408.4.1 EXCEPTION: LIGHTING CONTROL SYSTEMS ARE EXEMPT FROM THE COMMISSIONING PROCESS IN BUILDINGS WHERE:

1. THE TOTAL INSTALLED LIGHTING LOAD IS LESS THAN 20 KW, AND
2. THE LIGHTING LOAD CONTROLLED BY OCCUPANCY SENSORS OR AUTOMATIC DAYLIGHTING CONTROLS IS LESS THAN 10 KW.

C408.5 EQUIPMENT, COMPONENTS, CONTROLS OR CONFIGURATION SETTINGS FOR SYSTEMS WHICH ARE INCLUDED IN THE PROJECT TO COMPLY WITH SECTION C406 OR C407 SHALL BE INCLUDED IN THE COMMISSIONING PROCESS REQUIRED BY SECTION C408.1.

C408.6 ENERGY METERING SYSTEMS REQUIRED BY SECTION C409 SHALL COMPLY WITH SECTION C408.6 AND BE INCLUDED IN THE COMMISSIONING PROCESS REQUIRED BY SECTION C408.1. THE COMMISSIONING PROCESS SHALL INCLUDE ALL ENERGY METERING EQUIPMENT AND CONTROLS REQUIRED BY SECTION C409.

C408.7 ALL INSTALLED REFRIGERATION SYSTEMS SUBJECT TO SECTION C410 SHALL BE INCLUDED IN THE COMMISSIONING PROCESS REQUIRED BY SECTION C408.1. EXCEPTIONS:

1. SELF-CONTAINED REFRIGERATION SYSTEMS ARE EXEMPT FROM THE COMMISSIONING PROCESS.
2. TOTAL INSTALLED CAPACITY FOR REFRIGERATION IS EQUAL TO OR LESS THAN 240,000 BTUH.

WASHINGTON STATE CLOSE OUT DOCUMENTATION

C103.6 THE CONSTRUCTION DOCUMENTS SHALL SPECIFY THAT THE DOCUMENTS DESCRIBED IN THIS SECTION BE PROVIDED TO THE BUILDING OWNER OR OWNER'S AUTHORIZED AGENT WITHIN A MAXIMUM 90 DAYS OF THE DATE OF RECEIPT OF THE CERTIFICATION OF OCCUPANCY. (C103.6.1 RECORD DOCUMENTS, C103.6.2 BUILDING OPERATIONS AND MAINTENANCE INFORMATION, C103.6.2.1 MANUALS, C103.6.3 COMPLIANCE DOCUMENTATION, C103.6.4 SYSTEMS OPERATION TRAINING)

WASHINGTON STATE ENERGY CODE

C403.4.1 THE SUPPLY OF HEATING AND COOLING ENERGY TO EACH ZONE SHALL BE CONTROLLED BY INDIVIDUAL THERMOSTATIC CONTROLS CAPABLE OF RESPONDING TO TEMPERATURE WITHIN THE ZONE.

C403.4.1.1 UNITARY AIR COOLED HEAT PUMPS SHALL INCLUDE MICROPROCESSOR CONTROLS THAT MINIMIZE SUPPLEMENTAL HEAT USAGE DURING START-UP, SET-UP, AND DEFROST CONDITIONS. THESE CONTROLS SHALL ANTICIPATE NEED FOR HEAT AND USE COMPRESSION HEATING AS THE FIRST STAGE OF HEAT. CONTROLS SHALL INDICATE WHEN SUPPLEMENTAL HEATING IS BEING USED THROUGH VISUAL MEANS (E.G., LED INDICATORS). HEAT PUMPS EQUIPPED WITH SUPPLEMENTAL HEATERS SHALL BE INSTALLED WITH CONTROLS THAT PREVENT SUPPLEMENTAL HEATER OPERATION ABOVE 40F.

C403.4.1.2 WHERE USED TO CONTROL BOTH HEATING AND COOLING, ZONE THERMOSTATIC CONTROLS SHALL BE CONFIGURED TO PROVIDE A TEMPERATURE RANGE OR DEADBAND OF AT LEAST 5F WITHIN WHICH THE SUPPLY OF HEATING AND COOLING ENERGY TO THE ZONE IS SHUT OFF OR REDUCED TO A MINIMUM.

C403.7.8.1 OUTDOOR AIR SUPPLY, EXHAUST OPENINGS AND RELIEF OUTLETS AND STAIRWAY AND ELEVATOR HOISTWAY SHAFT VENTS SHALL BE PROVIDED WITH CLASS 1 MOTORIZED DAMPERS. SEE SECTIONS C403.10.1 AND C403.10.2 FOR DUCTWORK INSULATION REQUIREMENTS UPSTREAM AND DOWNSTREAM OF THE SHUTOFF DAMPER. EXCEPTION:

1. GRAVITY (NONMOTORIZED) DAMPERS SHALL BE PERMITTED IN LIEU OF MOTORIZED DAMPERS AS FOLLOWS:
 - 1.1. RELIEF DAMPERS SERVING SYSTEMS LESS THAN 5,000 CFM TOTAL SUPPLY SHALL BE PERMITTED IN BUILDINGS LESS THAN THREE STORIES IN HEIGHT.
 - 1.2. GRAVITY (NONMOTORIZED) DAMPERS WHERE THE DESIGN OUTDOOR AIR INTAKE OR EXHAUST CAPACITY DOES NOT EXCEED 400 CFM.
 - 1.3. SYSTEMS SERVING AREAS WHICH REQUIRE CONTINUOUS OPERATION FOR 24/7 OCCUPANCY SCHEDULES.
2. SHUTOFF DAMPERS ARE NOT REQUIRED IN:
 - 2.1. COMBUSTION AIR INTAKES.
 - 2.2. SYSTEMS SERVING AREAS WHICH REQUIRE CONTINUOUS OPERATION IN ANIMAL HOSPITALS, KENNELS AND POUNDS, LABORATORIES, GROUP H, I AND R OCCUPANCIES.
 - 2.3. SUBDUCT EXHAUST SYSTEMS OR OTHER SYSTEMS THAT ARE REQUIRED TO OPERATE CONTINUOUSLY BY THE INTERNATIONAL MECHANICAL CODE.
 - 2.4. TYPE I GREASE EXHAUST SYSTEMS OR OTHER SYSTEMS WHERE DAMPERS ARE PROHIBITED BY THE INTERNATIONAL MECHANICAL CODE TO BE IN THE AIRSTREAM.
 - 2.5. UNCONDITIONED STAIRWELLS OR UNCONDITIONED ELEVATOR HOISTWAY SHAFTS THAT ARE ONLY CONNECTED TO UNCONDITIONED SPACES.

C403.7.8.2 RETURN AIR OPENINGS USED FOR AIRSIDE ECONOMIZER OPERATION SHALL BE EQUIPPED WITH CLASS 1 MOTORIZED DAMPERS.

C403.7.8.3 CLASS 1 DAMPERS SHALL HAVE A MAXIMUM LEAKAGE RATE OF 4 CFM/SF WHEN TESTED IN ACCORDANCE WITH AMCA 500P AND SHALL BE LABELED BY AN APPROVED AGENCY FOR SUCH PURPOSE. GRAVITY (NONMOTORIZED) DAMPERS SHALL HAVE AN AIR LEAKAGE RATE NOT GREATER THAN 20 CFM/SF WHERE NOT LESS THAN 24 INCHES IN EITHER DIMENSION AND 40 CFM/SF WHERE LESS THAN 24 INCHES IN EITHER DIMENSION. THE RATE OF AIR LEAKAGE SHALL BE DETERMINED AT 1.0 INCH W.G. WHEN TESTED IN ACCORDANCE WITH AMCA500P FOR SUCH PURPOSE. THE DAMPERS SHALL BE LABELED BY AN APPROVED AGENCY. GRAVITY DAMPERS FOR VENTILATION AIR INTAKES SHALL BE PROTECTED FROM DIRECT EXPOSURE TO

WIND. EXCEPTIONS:

1. GRAVITY (NONMOTORIZED) DAMPERS ARE NOT REQUIRED TO BE TESTED TO VERIFY THE AIR LEAKAGE RATING WHEN INSTALLED IN EXHAUST SYSTEMS WHERE THE EXHAUST CAPACITY DOES NOT EXCEED 400 CFM AND THE GRAVITY DAMPER IS PROVIDED WITH A GASKETED SEAL.
2. MOTORIZED DAMPERS ON RETURN AIR OPENINGS IN UNITARY PACKAGED EQUIPMENT THAT HAVE THE MINIMUM LEAKAGE RATE AVAILABLE FROM THE MANUFACTURER.

C403.7.8.4 OUTDOOR AIR INTAKE, RELIEF AND EXHAUST SHUTOFF DAMPERS SHALL BE INSTALLED WITH AUTOMATIC CONTROLS CONFIGURED TO CLOSE WHEN THE SYSTEMS OR SPACES SERVED ARE NOT IN USE OR DURING UNOCCUPIED PERIOD WARM-UP AND SETBACK OPERATION, UNLESS THE SYSTEMS SERVED REQUIRE OUTDOOR OR EXHAUST AIR IN ACCORDANCE WITH THE INTERNATIONAL MECHANICAL CODE OR THE DAMPERS ARE OPENED TO PROVIDE INTENTIONAL ECONOMIZER COOLING. STAIRWAY AND ELEVATOR HOISTWAY SHAFT VENT DAMPERS SHALL BE INSTALLED WITH AUTOMATIC CONTROLS CONFIGURED TO OPEN UPON THE ACTIVATION OF ANY FIRE ALARM INITIATING DEVICE OF THE BUILDING'S FIRE ALARM SYSTEM OF THE INTERRUPTION OF POWER TO THE DAMPER.

C403.10.1.1 DUCTS, SHAFTS AND PLENUMS CONVEYING OUTSIDE AIR FROM THE EXTERIOR OF THE BUILDING TO THE MECHANICAL SYSTEM SHALL MEET ALL AIR LEAKAGE AND BUILDING ENVELOPE INSULATION REQUIREMENTS OF SECTION C402, PLUS BUILDING ENVELOPE VAPOR CONTROL REQUIREMENTS FROM THE INTERNATIONAL BUILDING CODE. EXTENDING CONTINUOUSLY FROM THE BUILDING EXTERIOR TO AN AUTOMATIC SHUTOFF DAMPER OR HEATING OR COOLING EQUIPMENT, FOR THE PURPOSES OF BUILDING ENVELOPE INSULATION REQUIREMENTS, DUCT SURFACES SHALL BE INSULATED WITH THE MINIMUM INSULATION VALUES IN TABLE C403.10.1.1. DUCT SURFACES INCLUDED AS PART OF THE BUILDING ENVELOPE SHALL NOT BE USED IN THE CALCULATION OF MAXIMUM GLAZING AREA AS DESCRIBED IN SECTION C402.4.1. EXCEPTIONS:

1. OUTDOOR AIR DUCTS SERVING INDIVIDUAL SUPPLY AIR UNITS WITH LESS THAN 2,800 CFM OF TOTAL SUPPLY AIR CAPACITY, PROVIDED THESE ARE INSULATED TO THE MINIMUM INSULATION VALUES IN TABLE C403.10.1.1.
2. UNHEATED EQUIPMENT ROOMS WITH COMBUSTION AIR LOUVERS, PROVIDED THEY ARE ISOLATED FROM CONDITIONED SPACE AT SIDES, TOP AND BOTTOM OF THE ROOM WITH R-11 NOMINAL INSULATION.

C403.10.1.2 ALL OTHER SUPPLY AND RETURN AIR DUCTS AND PLENUMS SHALL BE INSULATED WITH A MINIMUM OF R-6 INSULATION WHERE LOCATED IN UNCONDITIONED SPACES, AND WHERE LOCATED OUTSIDE THE BUILDING WITH A MINIMUM OF R-8 INSULATION IN CLIMATE ZONE 4 AND R-12 INSULATION IN CLIMATE ZONE 5, WHERE LOCATED WITHIN A BUILDING ENVELOPE ASSEMBLY, THE DUCT OR PLENUM SHALL BE SEPARATED FROM THE BUILDING EXTERIOR OR UNCONDITIONED OR EXEMPT SPACES BY A MINIMUM INSULATION VALUE AS REQUIRED FOR EXTERIOR WALLS BY SECTION C402.1.3. EXCEPTIONS:

1. WHERE LOCATED WITHIN EQUIPMENT.
2. SUPPLY AND RETURN DUCTWORK LOCATED IN UNCONDITIONED SPACES WHERE THE DESIGN TEMPERATURE DIFFERENCE BETWEEN THE INTERIOR AND EXTERIOR OF THE DUCT OR PLENUM DOES NOT EXCEED 15F AND INSULATED IN ACCORDANCE WITH TABLE C403.10.1.2.

WHERE LOCATED WITHIN CONDITIONED SPACE, SUPPLY DUCTS WHICH CONVEY SUPPLY AIR AT TEMPERATURES LESS THAN 55F OR GREATER THAN 105F SHALL BE INSULATED WITH A MINIMUM INSULATION R-VALUE IN ACCORDANCE WITH TABLE C403.10.1.2. EXCEPTION: DUCTWORK EXPOSED TO VIEW WITHIN A ZONE THAT SERVES THAT ZONE IS NOT REQUIRED TO BE INSULATED.

WHERE LOCATED WITHIN CONDITIONED SPACE, RETURN OR EXHAUST AIR DUCTS THAT CONVEY RETURN OR EXHAUST AIR DOWNSTREAM OF AN ENERGY RECOVERY MEDIA SHALL BE INSULATED WITH A MINIMUM R-VALUE IN ACCORDANCE WITH TABLE C403.10.1.2.

ALL DUCTS, AIR HANDLERS, AND FILTER BOXES SHALL BE SEALED, JOINTS AND SEAMS SHALL COMPLY WITH SECTION 603.9 OF THE INTERNATIONAL MECHANICAL CODE.

C403.10.2 DUCTWORK SHALL BE CONSTRUCTED AND ERECTED IN ACCORDANCE WITH THE INTERNATIONAL MECHANICAL CODE.

C403.10.3 ALL PIPING SERVING AS PART OF A HEATING OR COOLING SYSTEM SHALL BE THERMALLY INSULATED IN ACCORDANCE WITH TABLE C403.10.3. EXCEPTIONS:

1. FACTORY-INSTALLED PIPING WITHIN HVAC EQUIPMENT TESTED AND RATED IN ACCORDANCE WITH A TEST PROCEDURE REFERENCED BY THIS CODE.
2. FACTORY-INSTALLED PIPING WITHIN ROOM FAN-COILS AND UNIT VENTILATORS TESTED AND RATED ACCORDING TO AHRI 440 (EXCEPT THAT THE SAMPLING AND VARIATION PROVISIONS OF SECTION 6.5 SHALL NOT APPLY) AND 840, RESPECTIVELY.
3. PIPING THAT CONVEYS FLUIDS THAT HAVE A DESIGN OPERATING TEMPERATURE RANGE BETWEEN 60F AND 105F.
4. PIPING THAT CONVEYS FLUIDS THAT HAVE NOT BEEN HEATED OR COOLED THROUGH THE USE OF FOSSIL FUELS OR ELECTRIC POWER.
5. STRAINERS, CONTROL VALVES, AND BALANCING VALVES ASSOCIATED WITH PIPING 1 INCH OR LESS IN DIAMETER.
6. DIRECT BURIED PIPING THAT CONVEYS FLUIDS AT OR BELOW 60F.

C403.5 AIR ECONOMIZERS SHALL BE PROVIDED ON ALL NEW COOLING SYSTEMS INCLUDING THOSE SERVING COMPUTER SERVER ROOMS, ELECTRONIC EQUIPMENT, RADIO EQUIPMENT, AND TELEPHONE SWITCHGEAR. ECONOMIZERS SHALL COMPLY WITH SECTIONS C403.5.1 THROUGH C403.5.5. NOTE: ECONOMIZERS ARE NOT REQUIRED FOR SYSTEMS THAT MEET THE REQUIREMENTS OF SECTION C403.5, EXCEPTIONS 1 THROUGH 11.

C403.5.1 ECONOMIZER SYSTEMS SHALL BE INTEGRATED WITH THE MECHANICAL COOLING SYSTEM AND BE CONFIGURED TO PROVIDE PARTIAL COOLING EVEN WHERE ADDITIONAL MECHANICAL COOLING IS REQUIRED TO PROVIDE THE REMAINDER OF THE COOLING LOAD. CONTROLS SHALL NOT BE CAPABLE OF CREATING A FALSE LOAD IN THE MECHANICAL COOLING SYSTEM BY LIMITING OR DISABLING THE ECONOMIZER OR ANY OTHER MEANS, SUCH AS HOT GAS BYPASS, EXCEPT AT THE LOWEST STAGE OF MECHANICAL COOLING. UNITS THAT INCLUDE AN AIR ECONOMIZER SHALL COMPLY WITH THE FOLLOWING:

1. UNIT CONTROLS SHALL HAVE THE MECHANICAL COOLING CAPACITY CONTROL INTERLOCKED WITH THE AIR ECONOMIZER CONTROLS SUCH THAT THE OUTDOOR AIR DAMPER IS AT THE 100 PERCENT OPEN POSITION WHEN MECHANICAL COOLING IS ON AND THE OUTDOOR AIR DAMPER DOES NOT BEGIN TO CLOSE TO PREVENT COIL FREEZING DUE TO MINIMUM COMPRESSOR RUN TIME UNTIL THE LEAVING AIR TEMPERATURE IS LESS THAN 45F;
2. DIRECT EXPANSION (DX) UNITS WITH COOLING CAPACITY 65,000 BTUH OR GREATER OF RATED CAPACITY SHALL COMPLY WITH THE FOLLOWING:
 3. 2.1 DX UNITS THAT CONTROL THE CAPACITY OF THE MECHANICAL COOLING DIRECTLY BASED ON OCCUPIED SPACE TEMPERATURE SHALL HAVE NOT FEWER THAN TWO STAGES OF MECHANICAL COOLING CAPACITY.
 4. 2.2 OTHER DX UNITS, INCLUDING THOSE THAT CONTROL SPACE TEMPERATURE BY MODULATING THE AIRFLOW TO THE SPACE, SHALL BE IN ACCORDANCE WITH TABLE C403.5.1.

C403.5.2 HVAC SYSTEM DESIGN AND ECONOMIZER CONTROLS SHALL BE SUCH THAT ECONOMIZER OPERATION DOES NOT INCREASE BUILDING HEATING ENERGY USE DURING NORMAL OPERATION. EXCEPTION: ECONOMIZERS ON VAV SYSTEMS THAT CAUSE ZONE LEVEL HEATING TO INCREASE DUE TO A REDUCTION IN SUPPLY AIR TEMPERATURE. C403.5.3.1 AIR ECONOMIZER SYSTEMS SHALL BE CONFIGURED TO MODULATE OUTDOOR AIR AND RETURN AIR DAMPERS TO PROVIDE UP TO 100 PERCENT OF THE DESIGN SUPPLY AIR QUANTITY AS OUTDOOR AIR FOR COOLING.

C403.5.3.2 ECONOMIZER CONTROLS AND DAMPERS SHALL BE CONFIGURED TO SEQUENCE THE DAMPERS WITH MECHANICAL COOLING EQUIPMENT AND SHALL NOT BE CONTROLLED BY ONLY MIXED AIR TEMPERATURE. AIR ECONOMIZERS ON SYSTEMS WITH COOLING CAPACITY GREATER THAN 65,000 BTUH SHALL BE CONFIGURED TO PROVIDE PARTIAL COOLING EVEN WHEN ADDITIONAL MECHANICAL COOLING IS REQUIRED TO MEET THE REMAINDER OF THE COOLING LOAD. EXCEPTION: THE USE OF MIXED AIR TEMPERATURE LIMIT CONTROL SHALL BE PERMITTED FOR SYSTEMS THAT ARE BOTH CONTROLLED FROM SPACE TEMPERATURE (SUCH AS SINGLE ZONE SYSTEMS) AND HAVING COOLING CAPACITY LESS THAN 65,000 BTUH.

C403.5.3.3 AIR ECONOMIZERS SHALL BE CONFIGURED TO AUTOMATICALLY REDUCE OUTDOOR AIR INTAKE TO THE DESIGN MINIMUM OUTDOOR AIR QUANTITY WHEN OUTDOOR AIR INTAKE WILL NO LONGER REDUCE COOLING ENERGY USAGE. HIGH-LIMIT SHUTOFF CONTROL TYPES SHALL BE CHOSEN FROM TABLE C403.5.3.3. HIGH-LIMIT SHUTOFF CONTROL SETTINGS FOR THESE CONTROL TYPES SHALL BE THOSE SPECIFIED TO TABLE C403.5.3.3.

C403.5.3.4 SYSTEMS SHALL BE CAPABLE OF RELIEVING EXCESS OUTDOOR AIR DURING AIR ECONOMIZER OPERATION TO PREVENT OVER-PRESSURIZING THE BUILDING. THE RELIEF AIR OUTLET SHALL BE LOCATED TO AVOID RECIRCULATION INTO THE BUILDING.

C403.5.3.5 RETURN, EXHAUST/RELIEF AND OUTDOOR AIR DAMPERS USED IN ECONOMIZERS SHALL COMPLY WITH SECTION C403.7.8.

C409.1 ALL NEW BUILDINGS AND ADDITIONS SHALL HAVE THE CAPABILITY OF METERING SOURCE ENERGY FOR ON-SITE RENEWABLE ENERGY PRODUCTION IN ACCORDANCE WITH SECTION C409.2.4 AND THE END-USE ENERGY USAGE FOR ELECTRIC VEHICLE CHARGING IN ACCORDANCE WITH SECTION C409.3.4. NEW BUILDINGS AND ADDITIONS WITH A GROSS CONDITIONED FLOOR AREA OVER 50,000 SQUARE FEET SHALL COMPLY WITH SECTION C409. BUILDINGS SHALL BE EQUIPPED TO MEASURE, MONITOR, RECORD AND DISPLAY ENERGY CONSUMPTION DATA FOR EACH ENERGY SOURCE AND END USE CATEGORY PER THE PROVISIONS OF THIS SECTION, TO ENABLE EFFECTIVE ENERGY MANAGEMENT. EXCEPTIONS:

1. TENANT SPACES SMALLER THAN 50,000 SQUARE FEET WITHIN BUILDINGS IF TENANT SPACE HAS ITS OWN UTILITY SERVICE AND UTILITY METERS.
2. BUILDINGS IN WHICH THERE IS NO GROSS CONDITIONED FLOOR AREA OVER 25,000 SQUARE FEET, INCLUDING BUILDING COMMON AREA, THAT IS SERVED BY ITS OWN UTILITY SERVICES AND METERS.

RESIDENTIAL ENERGY CODE

1. WHOLE-HOUSE FAN EFFICACY PER TABLE R403.6.1.
2. EQUIPMENT AND APPLIANCE SIZING PER R403.7, HEATING AND COOLING EQUIPMENT AND APPLIANCES SHALL BE SIZED IN ACCORDANCE WITH ACCA MANUAL S OR OTHER APPROVED SIZING METHODOLOGIES BASED ON BUILDING LOADS CALCULATED IN ACCORDANCE WITH ACCA MANUAL J OR OTHER APPROVED HEATING AND COOLING CALCULATION METHODOLOGIES
3. ELECTRIC RESISTANCE ZONE PER R403.7.1, ELECTRIC ZONAL HEATING AS PRIMARY HEAT SOURCE SHALL INSTALL DUCTLESS MINI-SPLIT HEAT PUMP IN THE LARGEST ZONE IN THE DWELLING UNLESS TOTAL INSTALLED HEATING CAPACITY OF 2 KW PER DWELLING OR LESS.
4. PROVIDED ONE THERMOSTAT FOR EACH HEATING AND COOLING SYSTEM PER R403.1.
5. PER R403.3.6, SUPPLY AND RETURN DUCTS IN CEILING INSULATION SHALL HAVE MIN R-8 INSULATION ALL AROUND. THE SUM OF THE CEILING INSULATION OF THE TOP AND BELOW OF THE DUCT SHALL BE MIN R-19, EXCLUDING THE R-VALUE OF THE DUCT INSULATION.
6. MECHANICAL SYSTEM PIPING CARRYING FLUIDS ABOVE 105F OR BELOW 55F SHALL BE INSULATED WITH MIN R-6 PER R403.4. INSULATION SHALL BE PROTECTED FROM DAMAGE AND SHALL PROVIDE SHIELDING FROM SOLAR RADIATION. ADHESIVE TAPE SHALL NOT BE PERMITTED.

DUCT INSULATION SCHEDULE

	SERVICE (1)(3)(4)(5)	MATERIAL (6)	R-VALUE (MIN. INSTALLED)
WSEC	SUPPLY & RETURN AIR DUCTS IN UNCONDITIONED SPACE	MINERAL-WOOL BLANKET	6.0
	SUPPLY & RETURN AIR DUCTS LOCATED OUTSIDE THE BUILDING	MINERAL-WOOL BLANKET	8.0
	SUPPLY WITH SA TEMP <55F OR >105F WITHIN CONDITIONED SPACE	MINERAL-WOOL BLANKET	3.3
	SUPPLY DUCTS EXPOSED WITHIN CONDITIONED SPACE	MINERAL-WOOL BLANKET	0.0
WSMC	OUTSIDE AIR FROM EXTERIOR OF BUILDING TO AUTOMATIC SHUT-OFF DAMPER OR HEATING OR COOLING EQUIPMENT AND GREATER THAN 2,800 CFM	MINERAL-WOOL BLANKET	NOTE 2
	OUTSIDE AIR FROM EXTERIOR OF BUILDING TO AUTOMATIC SHUT-OFF DAMPER OR HEATING OR COOLING EQUIPMENT AND LESS THAN 2,800 CFM	MINERAL-WOOL BLANKET	7.0
	OUTSIDE AIR DUCT IN UNHEATED EQUIPMENT ROOMS WITH COMBUSTION AIR LOUVERS, ISOLATED FROM CONDITIONED SPACE AT SIDES, TOP AND BOTTOM WITH R-11 INSULATION	MINERAL-WOOL BLANKET	0.0
	OUTSIDE AIR DUCT IN CONDITION SPACE	MINERAL-WOOL BLANKET	4.0
WSMC	FOR HEAT OR ENERGY RECOVERY VENTILATION SYSTEM, DUCT UPSTREAM OF HEAT EXCHANGER	MINERAL-WOOL BLANKET	4.0
	EXHAUST DUCTS IN UNCONDITIONED SPACE	MINERAL-WOOL BLANKET	4.0


NOTES

- (1) DUCT INSULATION SHALL COMPLY WITH WSMC AND WSEC
- (2) DUCT SHALL MEET THE REQUIREMENTS OF METAL FRAMED WALLS PER WSEC TABLE C402.1.4
- (3) VAPOR RETARDER IS INSTALLED ON SUPPLY DUCT THAT DOES COOLING AND OUTSIDE AIR DUCT PER WSMC 604.11
- (4) EXTERNAL DUCT INSULATION IS IDENTIFIABLE PER WSMC 604.7
- (5) ALL DUCTWORK IS CONSTRUCTED AND SEALED PER WSMC
- (6) INSULATION SHALL HAVE A MAXIMUM FLAME SPREAD INDEX OF 25 AND MAXIMUM SMOKE DEVELOPED INDEX OF 50 PER WSMC 604.3

TABLE C403.10.3: MINIMUM PIPE INSULATION THICKNESS


FLUID OPERATING TEMPERATURE RANGE AND USAGE (°F)	INSULATION CONDUCTIVITY		ELECTRICAL				
	CONDUCTIVITY BTU·IN/(H·FT ² ·°F)	MEAN RATING TEMPERATURE, °F	1 TO < 1-1/2	1-1/2 TO < 4	4 TO < 8	8 TO < 15	≥ 15
> 350	0.32 – 0.34	250	4.5	5.0	5.0	5.0	5.0
251 – 350	0.29 – 0.32	200	3.0	4.0	4.5	4.5	4.5
201 – 250	0.27 – 0.30	150	2.5	2.5	2.5	3.0	3.0
141 – 200	0.25 – 0.29	125	1.5	1.5	2.0	2.0	2.0
105 – 140	0.21 – 0.28	100	1.0	1.0	1.5	1.5	1.5
40 – 60	0.21 – 0.27	75	0.5	0.5	1.0	1.0	1.0
< 40	0.20 – 0.26	75	0.5	1.0	1.0	1.0	1.5

NO.	DATE	DESCRIPTION	REVISIONS

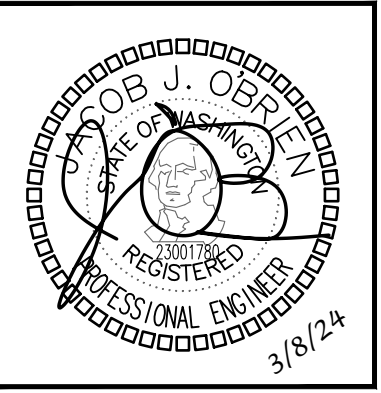

OF	ABE	PR	JMR
DRAWN:	DESIGNED:	CHECKED:	APPROVED:

PROJECT: EAST TOWN CROSSING BUILDING F MULTIFAMILY DEVELOPMENT PIONEER WAY & SHAW RD. PUYALLUP, WA

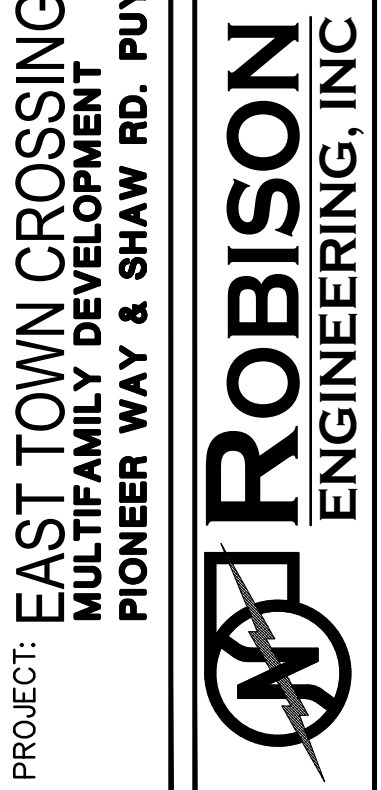

DATE: 3/8/2024

SHEET TITLE: PROJECT NOTES

ENERGY CODE NOTES

WSEC SECTION R406: ADDITIONAL ENERGY EFFICIENCY REQUIREMENTS

EACH DWELLING UNIT IN A RESIDENTIAL BUILDING SHALL COMPLY WITH SUFFICIENT CREDIT OPTIONS FROM SECTION R406. CREDIT FROM BOTH SECTIONS R406.2 AND R406.3 ARE REQUIRED:

- #1. SMALL DWELLING UNIT: 3.0 CREDITS
DWELLING UNITS LESS THAN 1500 SQUARE FEET IN CONDITIONED FLOOR AREA WITH LESS THAN 300 SQUARE FEET OF FENESTRATION AREA. ADDITIONS TO EXISTING BUILDING THAT ARE GREATER THAN 500 SQUARE FEET OF HEATED FLOOR AREA BUT LESS THAN 1500 SQUARE FEET.
- #2. MEDIUM DWELLING UNIT: 6.0 CREDITS
ALL DWELLING UNITS THAT ARE NOT INCLUDED IN #1, #3 OR #4.
- #3. LARGE DWELLING UNIT: 7.0 CREDITS
DWELLING UNITS EXCEEDING 5000 SQUARE FEET OF CONDITIONED FLOOR AREA.
- #4. DWELLING UNITS SERVING R-2 OCCUPANCIES: 4.5 CREDITS
- #5. ADDITIONS LESS THAN 500 SQUARE FEET: 1.5 CREDITS

TABLE R406.2 FUEL NORMALIZATION CREDITS

SYSTEM TYPE	DESCRIPTION	CREDITS	CREDIT TAKEN
1	COMBUSTION HEATING EQUIPMENT MEETING MINIMUM FEDERAL EFFICIENCY STANDARDS FOR THE EQUIPMENT LISTED IN TABLE C403.3.2(4) OR C403.3.2(5)	0.0	-
2	FOR AN INITIAL HEATING SYSTEM USING A HEAT PUMP THAT MEETS FEDERAL STANDARDS FOR EQUIPMENT LISTED IN TABLE C403.3.2(2)(C) OR C403.3.2(2) OR AIR TO WATER HEAT PUMP UNITS THAT ARE CONFIGURED TO PROVIDE BOTH HEATING AND COOLING AND ARE RATED IN ACCORDANCE WITH AHRI 550 / 590	1.0	1.0
3	FOR HEATING SYSTEM BASED ON ELECTRIC RESISTANCE ONLY (EITHER FORCED AIR OR ZONAL)	-1.0	-
4	FOR HEATING SYSTEM BASED ON ELECTRIC RESISTANCE WITH A DUCTLESS MINI-SPLIT HEAT PUMP SYSTEM IN ACCORDANCE WITH SECTION R403.7.1 INCLUDING THE EXCEPTION	N/A	-
5	ALL OTHER HEATING SYSTEMS	-1.0	-
TOTAL CREDITS			1.0

TABLE R406.3 ENERGY CREDITS

OPTION	DESCRIPTION	CREDITS	CREDIT TAKEN
EFFICIENT BUILDING ENVELOPE OPTIONS			
1	OPTION 1.1	0.5	-
	OPTION 1.2	1.0	-
	OPTION 1.3	N/A	-
	OPTION 1.4	1.0	-
	OPTION 1.5	1.5	-
	OPTION 1.6	2.0	-
	OPTION 1.7	0.5	-
AIR LEAKAGE CONTROL AND EFFICIENT VENTILATION OPTIONS			
2	OPTION 2.1	1.0	-
	OPTION 2.2	1.5	-
	OPTION 2.3	2.0	-
	OPTION 2.4	2.5	-
HIGH EFFICIENCY HVAC EQUIPMENT OPTIONS			
3	OPTION 3.1	1.0	-
	OPTION 3.2	N/A	-
	OPTION 3.3	1.0	-
	OPTION 3.4	2.0	-
	OPTION 3.5	N/A	-
	OPTION 3.6	3.0	3.0
HIGH EFFICIENCY HVAC DISTRIBUTION SYSTEM OPTIONS			
4	OPTION 4.1	0.5	-
	OPTION 4.2	N/A	-
EFFICIENT WATER HEATING OPTIONS			
5	OPTION 5.1	0.5	-
	OPTION 5.2	0.5	-
	OPTION 5.3	1.0	-
	OPTION 5.4	2.0	-
	OPTION 5.5	2.5	2.5
	OPTION 5.6	3.0	-
RENEWABLE ELECTRIC ENERGY OPTION			
6	OPTION 6.1	1.0	-
	APPLIANCE PACKAGE OPTION		
7	OPTION 7.1	1.5	-
	TOTAL CREDITS FROM TABLE R406.3		5.5
TOTAL CREDITS FROM TABLE R406.2		1.0	
TOTAL CREDITS		6.5	

WHOLE HOUSE VENTILATION NOTES

EACH DWELLING UNIT OR SLEEPING UNIT SHALL BE EQUIPPED WITH A WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM THAT COMPLIES WITH SECTIONS 403.4.1 THROUGH 403.4.6. EACH DWELLING UNIT OR SLEEPING UNIT SHALL BE EQUIPPED WITH LOCAL EXHAUST COMPLYING WITH SECTION 403.4.7. ALL OCCUPIED SPACES, INCLUDING PUBLIC CORRIDORS, OTHER THAN GROUP R DWELLING UNITS AND/OR SLEEPING UNITS, THAT SUPPORT THESE GROUP R OCCUPANCIES, SHALL MEET THE VENTILATION REQUIREMENTS OF SECTION 402 OR THE MECHANICAL VENTILATION REQUIREMENTS OF SECTIONS 403.1 THROUGH 403.3.

THE WHOLE HOUSE VENTILATION SYSTEM SHALL CONSIST OF ONE OR MORE SUPPLY FANS, ONE OR MORE EXHAUST FANS, OR AN ERV/HRV WITH INTEGRAL FANS; AND THE ASSOCIATED DUCTS AND CONTROLS. LOCAL EXHAUST FANS SHALL BE PERMITTED TO SERVE AS PART OF THE WHOLE-HOUSE VENTILATION SYSTEM WHEN PROVIDED WITH THE PROPER CONTROLS IN ACCORDANCE WITH SECTION 403.4.5. THE SYSTEMS SHALL BE DESIGNED AND INSTALLED TO SUPPLY AND EXHAUST THE MINIMUM OUTDOOR AIRFLOW RATES PER SECTION 403.4.2 AS CORRECTED BY THE BALANCED AND/OR DISTRIBUTED WHOLE-HOUSE VENTILATION SYSTEM COEFFICIENTS IN ACCORDANCE WITH SECTION 403.4.3 WHERE APPLICABLE.

THE DWELLING UNIT WHOLE-HOUSE MECHANICAL VENTILATION MINIMUM OUTDOOR AIRFLOW RATE SHALL BE DETERMINED IN ACCORDANCE WITH EQUATION 4-10 OR TABLE 403.4.2.

RESIDENTIAL DWELLING AND SLEEPING UNITS IN GROUP R-2 OCCUPANCIES SYSTEM SHALL INCLUDE SUPPLY AND EXHAUST FANS AND BE A BALANCED WHOLE-HOUSE VENTILATION SYSTEM IN ACCORDANCE WITH SECTION 403.4.6.3. THE SYSTEM SHALL INCLUDE A HEAT OR ENERGY RECOVERY VENTILATOR WITH A SENSIBLE HEAT RECOVERY EFFECTIVENESS AS PRESCRIBED IN SECTION C403.3.6 OF THE WASHINGTON STATE ENERGY CODE. THE WHOLE-HOUSE VENTILATION SYSTEM SHALL OPERATE CONTINUOUSLY AT THE MINIMUM VENTILATION RATE DETERMINED IN ACCORDANCE WITH SECTION 403.4. THE WHOLE-HOUSE SUPPLY FAN SHALL PROVIDE DUCTED OUTDOOR VENTILATION AIR TO EACH HABITABLE SPACE WITHIN THE RESIDENTIAL UNIT.

CONTROLS FOR THE WHOLE-HOUSE VENTILATION SYSTEM SHALL COMPLY WITH THE FOLLOWING:

- THE WHOLE-HOUSE VENTILATION SYSTEM SHALL BE CONTROLLED WITH MANUAL SWITCHES, TIMERS OR OTHER MEANS THAT PROVIDE FOR AUTOMATIC OPERATION OF THE VENTILATION SYSTEM THAT HAVE READY ACCESS FOR THE OCCUPANT.
- THE WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM SHALL BE PROVIDED WITH CONTROLS THAT ENABLE MANUAL OVERRIDE OFF OF THE SYSTEM BY THE OCCUPANT DURING PERIODS OF POOR OUTDOOR AIR QUALITY. CONTROLS SHALL INCLUDE PERMANENT TEXT OR A SYMBOL INDICATING THEIR FUNCTION. RECOMMENDED CONTROL PERMANENT LABELING TO INCLUDE TEXT SIMILAR TO THE FOLLOWING; "LEAVE ON UNLESS OUTDOOR AIR QUALITY IS VERY POOR." MANUAL CONTROLS SHALL HAVE READY ACCESS FOR THE OCCUPANT.
- WHOLE-HOUSE VENTILATION SYSTEMS SHALL BE CONFIGURED TO OPERATE CONTINUOUSLY EXCEPT WHERE INTERMITTENT OFF CONTROLS ARE PROVIDED IN ACCORDANCE WITH SECTION 403.4.6.5 AND ALLOWED BY SECTION 403.4.4.2.

WHOLE HOUSE VENTILATION SUPPLY AND EXHAUST FANS SPECIFIED IN THIS SECTION SHALL HAVE A MINIMUM EFFICACY AS PRESCRIBED IN THE WASHINGTON STATE ENERGY CODE. THE FANS SHALL BE RATED FOR SOUND AT A MAXIMUM OF 1.0 SOME AT DESIGN AIRFLOW AND STATIC PRESSURE CONDITIONS. DESIGN AND INSTALLATION OF THE SYSTEM OR EQUIPMENT SHALL BE CARRIED OUT IN ACCORDANCE WITH MANUFACTURERS' INSTALLATION INSTRUCTIONS

A BALANCED WHOLE HOUSE VENTILATION SYSTEM SHALL INCLUDE BOTH SUPPLY AND EXHAUST FANS. THE SUPPLY AND EXHAUST FANS SHALL HAVE AIRFLOW THAT IS WITHIN 10 PERCENT OF EACH OTHER. THE TESTED AND BALANCED TOTAL MECHANICAL EXHAUST AIRFLOW RATE IS WITHIN 10 PERCENT OR 5 CFM, WHICHEVER IS GREATER, OF THE TOTAL MECHANICAL SUPPLY AIRFLOW RATE. THE FLOW RATE TEST RESULTS SHALL BE SUBMITTED AND POSTED IN ACCORDANCE WITH SECTION 403.4.6.6. THE EXHAUST FAN SHALL MEET THE REQUIREMENTS OF SECTION 403.4.6.2. THE SUPPLY FAN SHALL MEET THE REQUIREMENTS OF SECTION 403.4.6.3. FOR R-2 DWELLING AND SLEEPING UNITS, THE SYSTEM IS REQUIRED TO HAVE BALANCED WHOLE-HOUSE VENTILATION BUT IS NOT REQUIRED TO HAVE DISTRIBUTED WHOLE-HOUSE VENTILATION WHERE THE NOT DISTRIBUTED SYSTEM COEFFICIENT FROM TABLE 403.4.3 IS UTILIZED TO CORRECT THE WHOLE-HOUSE MECHANICAL VENTILATION RATE. THE SYSTEM SHALL BE DESIGNED AND BALANCED TO MEET THE PRESSURE EQUALIZATION REQUIREMENTS OF SECTION 501.4. INTERMITTENT DRYER EXHAUST, INTERMITTENT RANGE HOOD EXHAUST, AND INTERMITTENT TOILET ROOM EXHAUST AIRFLOW RATES ABOVE THE RESIDENTIAL DWELLING OR SLEEPING UNIT MINIMUM VENTILATION RATE ARE EXEMPT FROM THE BALANCED AIRFLOW CALCULATION.

FACTORY-BUILT INTAKE/EXHAUST COMBINATION TERMINATIONS

PER 2018 IMC 401.4.3, ITEM 3, EXCEPTION, SEPARATION IS NOT REQUIRED BETWEEN INTAKE AIR OPENINGS AND LIVING SPACE RELIEF AIR EXHAUST AIR OPENINGS OF AN INDIVIDUAL DWELLING UNIT OR SLEEPING UNIT, NOT TO INCLUDE COMMON AREAS OUTSIDE OF THE DWELLING OR SLEEPING UNIT, WHERE A FACTORY-BUILT INTAKE/EXHAUST COMBINATION TERMINATION FITTING, LISTED AND INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS, IS USED TO SEPARATE THE AIR STREAMS. A MINIMUM OF 5 FEET HORIZONTAL SEPARATION BETWEEN OTHER ENVIRONMENTAL AIR EXHAUST OUTLETS AND OTHER DWELLING OR SLEEPING UNIT FACTORY-BUILT INTAKE/EXHAUST COMBINATION TERMINATION FITTINGS SHALL BE MAINTAINED.

CALCULATIONS


RESIDENTIAL VENTILATION CALCULATIONS

UNIT TYPE	UNIT SQUARE FOOTAGE PER ARCHITECTURAL PLANS	NUMBER OF BEDROOMS	2015 IMC CRITERIA (1)			TOTAL CFM PROVIDED BY WHOLE HOUSE VENTILATION SYSTEM
			FLOOR AREA, SQFT	NUMBER OF BEDROOMS	REQUIRED CFM (2)	
11-3/21-3	634	1	501-1,000	0-1	30	50
11-7/21-9/31-9	659	1	501-1,000	0-1	30	50
11-8/21-4/31-4	679	2	501-1,000	2	35	50
21-2/31-2	958	2	501-1,000	2	35	50
12-1	1,021	2	1,001-1,500	2	40	50
12-3	1,000	2	501-1,000	2	35	50
12-5	957	2	501-1,000	2	35	50
22-1/32-1	1,022	2	1,001-1,500	2	40	50
22-2/32-2	958	2	501-1,000	2	35	50
22-5/32-5	958	2	501-1,000	2	35	50
22-6/32-6	1,000	2	501-1,000	2	35	50
31-3	645	1	501-1,000	0-1	30	50

NOTE: (1) VENTILATION CRITERIA IS PER THE 2018 IRC, TABLE 1505.4.3(1).

(2) MINIMUM OSA FOR CONTINUOUSLY OPERATING FAN(S).

NO.	DATE	DESCRIPTION

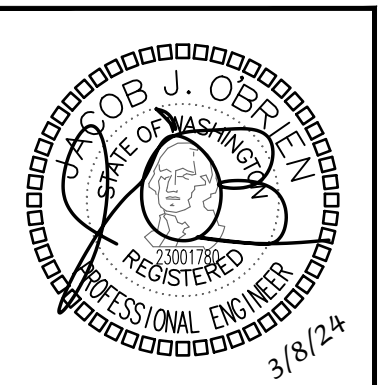

DRAWN: ABE	OP: JMR
DESIGNED: ABE	CHECKED: JMR
CHECKED: JMR	APPROVED: JMR

PROJECT: EAST TOWN CROSSING BUILDING F
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206/864-3343
REPROJECT NO.: 810010
CONTACT: ARK@ESPINELI

ROBISON ENGINEERING, INC.

DATE:
3/8/2024

SHEET TITLE:
TABLES & CALCULATIONS

SHEET NO.
M0.2

SCHEDULES

ENERGY RECOVERY VENTILATOR

EQUIP NO.	SERVICE	MOUNTING/ DISCHARGE	FAN		ELECTRICAL			SENSIBLE HEAT RECOVERY EFFICIENCY	BASIS OF DESIGN (1)(2)(3)
			AIRFLOW, CFM	ESP. IN WG	VOLTAGE	AMPS	MOCP		
ERV-1	RESIDENTIAL UNIT	HORIZONTAL	PER PLANS	0.4	120V/1P	1.1	15	0.69	ALDES E130-HF-N (4)
ERV-2	RESIDENTIAL UNIT	HORIZONTAL	PER PLANS	0.4	120V/1P	1.1	15	0.69	ALDES E130-HF-N-M (4)

- NOTES:
- (1) INSTALL IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION REQUIREMENTS.
 - (2) UNIT SHALL RUN CONTINUOUSLY.
 - (3) UNIT SHALL HAVE A MINIMUM MERV 8 FILTER.
 - (4) PROVIDE MANUFACTURER'S OPTIONAL WALL MOUNT SPEED CONTROLLER, PART NUMBER 611229. SPEED CONTROLLER SHALL BE MOUNTED NEXT TO THE LIGHT SWITCH FOR THE BATHROOM.

FAN SCHEDULE

EQUIP NO.	SERVICE	TYPE	AIRFLOW, CFM	ESP. IN WG	ELECTRICAL		OPERATION	WEIGHT, LBS	BASIS OF DESIGN (1)
					VOLTAGE	HP			
BEF-1	BATHROOM	CEILING MOUNTED	50	0.25	115V/1P	FHP	(2)	10	PANASONIC FV-0511VQ1 (3)
TF-1	TRANSFER FAN	IN WALL	50	0.1	120V/1P	[4.4]	(5)	8.82	PANASONIC FV-0510V51 (4)
TF-2	TRANSFER FAN	CEILING MOUNTED	50	0.1	120V/1P	[4.4]	(5)	8.82	PANASONIC FV-0510V51 (4)

- NOTES:
- (1) PROVIDE BACKDRAFT DAMPERS ON EXHAUST FANS.
 - (2) FAN SHALL BE ACTIVATED VIA WALL SWITCH.
 - (3) PROVIDE MANUFACTURER'S OPTIONAL CEILING RADIATION DAMPER.
 - (4) PROVIDE TRANSFER REGISTER BOX. BOD PANASONIC FV-JD
 - (5) FAN TO BE CONTROLLED BY WALL MOUNTED THERMOSTAT.

DIFFUSER SCHEDULE

CALLOUT	DESCRIPTION	AIRFLOW RANGE, CFM	FACE SIZE, IN	BASIS OF DESIGN
HRG-1	HARD LID RETURN GRILLE	0-700	12X12	TITUS 350ZRL
SSG-1	SIWALL SUPPLY GRILLE	0-150	10X4	SHOEMAKER 950
HSM-1	HARD LID SUPPLY GRILLE	0-150	10X4	SHOEMAKER 950

ELECTRIC HEATERS

EQUIP NO.	SERVICE	MOUNTING/ DISCHARGE	HEATING		ELECTRICAL		BASIS OF DESIGN (3)
			KW	VOLTAGE	VOLTAGE		
EWH-0.5	PER PLANS	WALL	0.5	208V/1P	208V/1P		(1)(2)
EWH-0.75	PER PLANS	WALL	0.75	208V/1P	208V/1P		(1)(2)
EWH-1.0	PER PLANS	WALL	1.0	208V/1P	208V/1P		(1)(2)
EWH-1.5	PER PLANS	WALL	1.5	208V/1P	208V/1P		(1)(2)
EWH-2.0	PER PLANS	WALL	2.0	208V/1P	208V/1P		(1)(2)

- NOTES:
- (1) BROAN, KING, CADET OR EQUIVALENT.
 - (2) PROVIDE INTEGRAL THERMOSTAT.
 - (3) ALL ELECTRIC HEATERS TO BE FURNISHED AND INSTALLED BY ELECTRICAL CONTRACTOR.

SPLIT SYSTEM HEAT PUMP SCHEDULE - INDOOR UNIT

EQUIP NO.	SERVICE	MOUNTING/ DISCHARGE	FAN		ELECTRICAL			BASIS OF DESIGN (1)(2)(4)	CONNECTED OUTDOOR UNIT
			AIRFLOW, CFM	ESP. IN WG	VOLTAGE	MCA	MOCP		
FCU-X	RES. UNIT	HIGH WALL	716	N/A	(3)	(3)	(3)	DAIKIN FTXB18BXVJU	HP-1


- NOTES:
- (1) INSTALL IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION REQUIREMENTS.
 - (2) PROVIDE MANUFACTURER'S OPTIONAL CONDENSATE PUMP WITH RESERVOIR AND SENSOR.
 - (3) INDOOR UNIT POWERED FROM OUTDOOR UNIT.
 - (4) "X" DENOTES THE UNIT BEING SERVED.

SPLIT SYSTEM HEAT PUMP SCHEDULE - OUTDOOR UNIT

EQUIP NO.	SERVICE	CAPACITY, TONS	TOTAL COOLING CAPACITY, BTUH	SEER	TOTAL HEATING CAPACITY, BTUH	HSPF	ELECTRICAL			DIMENSIONS, INCHES			WEIGHT, LBS	BASIS OF DESIGN (1)(2)(3)(4)(5)(6)	CONNECTED FAN COIL UNIT
							VOLTAGE	MCA	MOCP	H	W	D			
HP-1	RES. UNIT	1.5	18,000	18.8	17,900	10.0	208V/1P	16.55	20	27 ¹¹ / ₁₆	36 ⁷ / ₈	13 ¹ / ₂	97	DAIKIN RXB18BXVJU	FCU-1

- NOTES:
- (1) INSTALL IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION REQUIREMENTS.
 - (2) ARI LISTED WITH ALL STANDARD FEATURES. INSTALLATION ACCESSORIES AND COMPRESSOR SHORT CYCLING PROTECTION, FILTER DRIVER, REFRIGERANT LINE FILTER, LIQUID SOLENOID VALVE, AND SAFETY PRESSURE SWITCHES. INSTALL REFRIGERANT TUBING AND LENGTH IN STRICT ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
 - (3) PROVIDE ALL REQUIRED ACCESSORIES FOR LOW-AMBIENT.
 - (4) ROUTING OF REFRIGERANT LINES FROM INDOOR TO OUTDOOR UNITS NOT SHOWN ON PLANS. CONTRACTOR TO FIELD COORDINATE ROUTING.
 - (5) REFRIGERANT SHALL BE R-410A.
 - (6) "X" DENOTES THE UNIT BEING SERVED.

NO.	DATE	DESCRIPTION

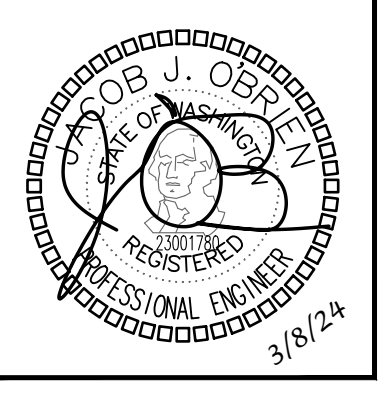

OP	DESIGNED:	CHECKED:	APPROVED:
DRAWN:	ABE	PR	JMR

PROJECT: EAST TOWN CROSSING BUILDING F
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206/864-3343
REI PROJECT NO.: 810010
CONTACT: ARK/ESP/INELI

ROBISON ENGINEERING, INC.

DATE:
3/8/2024

SHEET TITLE:
MECHANICAL SCHEDULES

SHEET NO.
M0.3

WSEC FORMS

3/8/24, 3:13 PM waenergycodes.com/print_project_summary_form.php?k=aWQ9MjMyNDAmZnZpPTE3JmN0aT00Ng==&print=1

MECHANICAL COMPLIANCE SUMMARY

2018 WSEC Compliance Forms for Commercial Buildings including Group R2, R3 & R4 over 3 stories and all R1 Administered by: ©2024 NEEA, All rights reserved

Project & Applicant Information	Project Title Pioneer & Shaw Puyallup, WA 98372	East Town Crossing Building F - 2018 WSEC	For Building Department Use:	Date: Mar 08, 2024
	Applicant Name Arick Espineli			
	Applicant Phone 206-364-3343			
	Applicant Email aespineli@robisonengineering.com			

For questions about this report, contact WSEC Commercial Technical Support at 360-539-5300 or via email at com.techsupport@waenergycodes.com

General Occupancy	All Group R - R2, R3 & R4 over 3 stories and all R1	General Building Use Type	Multi-family/Residential	Building Cond. Floor Area	27,753
General Project Types	New Building	New Building or Addition Mechanical Scope	Single Zone Systems & Equipment	Project Cond. Floor Area	27,753
			Alteration Mechanical Scope	Floors Above Grade	3
Mechanical Project Description				Compliance Method	Compliance Method 1 - General

Mechanical Compliance Scope and Method	Project Type	Mechanical Scope	Economizer Exception(s) Applied?	DOAS Ventilation Provided?	Higher Equipment Efficiency Option Applied?	Equipment Efficiency Compliance Verification
	New Building	Single Zone Systems & Equipment	Yes	Yes	Yes	COMPLIES

Additional Efficiency Credits Included (AEC)	Higher equipment efficiency and fan FEG		
Does building include occupancy classifications requiring DOAS?	No	Does project include DOAS equipment?	Yes
Based on project scope do TSPR requirements apply?	No	Do all systems comply with Appendix D standard reference design or qualify for an exception to TSPR?	No

Scope & Space Conditioning | **NEW BUILDING - SINGLE ZONE SYSTEMS & EQUIPMENT** | **Compliance Verification** | **COMPLIES**

Single Zone Air Systems Category - Heat pump, unitary, thru-wall, SDHV

Air Systems Summary Information	System/Equip ID	Quantity of Items	Supply Airflow Control	Ventilation Standard	Ventilation CFM (Total if Multiple Items)	Ventilation Air Source	Paired with DOAS	Ventilation energy recovery	Energy Recovery Efficiency (%)
	HP-1	24	Constant volume	IMC Ventilation		Other System		Provided but not required	69

Air Systems & Equipment - Cooling	System/Equip ID	Cooling System/Equip Type	Specific Type	Cooling Capacity per Item (Btu/h)	AEC Efficiency Multiplier	Econo Exception Multiplier (E1 & PL)	Combined Efficiency Multiplier (AEC & Econo)	Proposed Cooling Efficiency	CE Units	Proposed Part Load Efficiency	PL Units	Efficiency Compliance Verification
	HP-1	Heat pump, air cooled	Split system	18,000	1.15	1.15	1.3225	18.8	SEER		HEER	COMPLIES

Air Systems & Equipment - Heating	System/Equip ID	Heating System/Equip Type	Specific Type	Heat Pump Heating Capacity (Btu/h)	Cooling Capacity (Btu/h)	AEC Efficiency Multiplier	Proposed Heat Pump Heating Efficiency	HPH Units	Proposed Low OSA Temp Efficiency	LTH Units	Efficiency Compliance Verification
	HP-1	Heat pump, air cooled, heating	Split system	17,900	18,000	1.15	10.0	HSPF		COP	COMPLIES

Air Systems & Equipment Details


https://waenergycodes.com/print_project_summary_form.php?k=aWQ9MjMyNDAmZnZpPTE3JmN0aT00Ng==&print=1 1/2

3/8/24, 3:13 PM waenergycodes.com/print_project_summary_form.php?k=aWQ9MjMyNDAmZnZpPTE3JmN0aT00Ng==&print=1

System/Equip ID	Area(s) Served	Location in Project Documents - Plan/Detail #
HP-1	Apartment Units	M0.3
	System/Equip ID for a single or multiple items; Multiple items w/ identical heating & cooling capacity	
	Heating Section/Auxiliary Heating Type: Electric resistance (or None)	
	Air-side economizer exception applied: Exp 5(2) - Group R cooling units ≥ 20,000 - 54,000 Btu/h (Note equip location limitations)	
	Proposed Low OSA Temp Efficiency: LTH Units: COP	
	WSEC Equip Efficiency Reference Table - Heating: Table C403.3.2(2) - Unitary and Applied Heat Pumps	

https://waenergycodes.com/print_project_summary_form.php?k=aWQ9MjMyNDAmZnZpPTE3JmN0aT00Ng==&print=1 2/2

NO.	DATE	REVISIONS DESCRIPTION

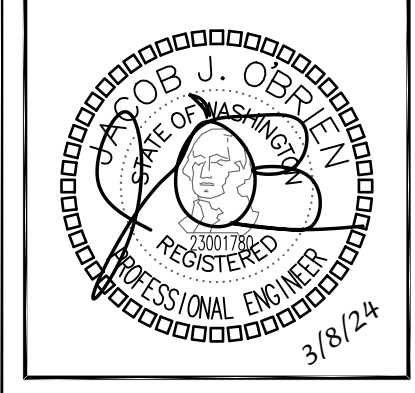

DRAWN: OP	CHECKED: JMR
DESIGNED: ABE	APPROVED: JMR


PROJECT: EAST TOWN CROSSING BUILDING F
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

CONTACT: ARICK ESPINELI
19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 364-3343
REPROJECT NO.: 810010

DATE:
3/8/2024

SHEET TITLE:
WSEC FORMS

SHEET NO.
M0.4


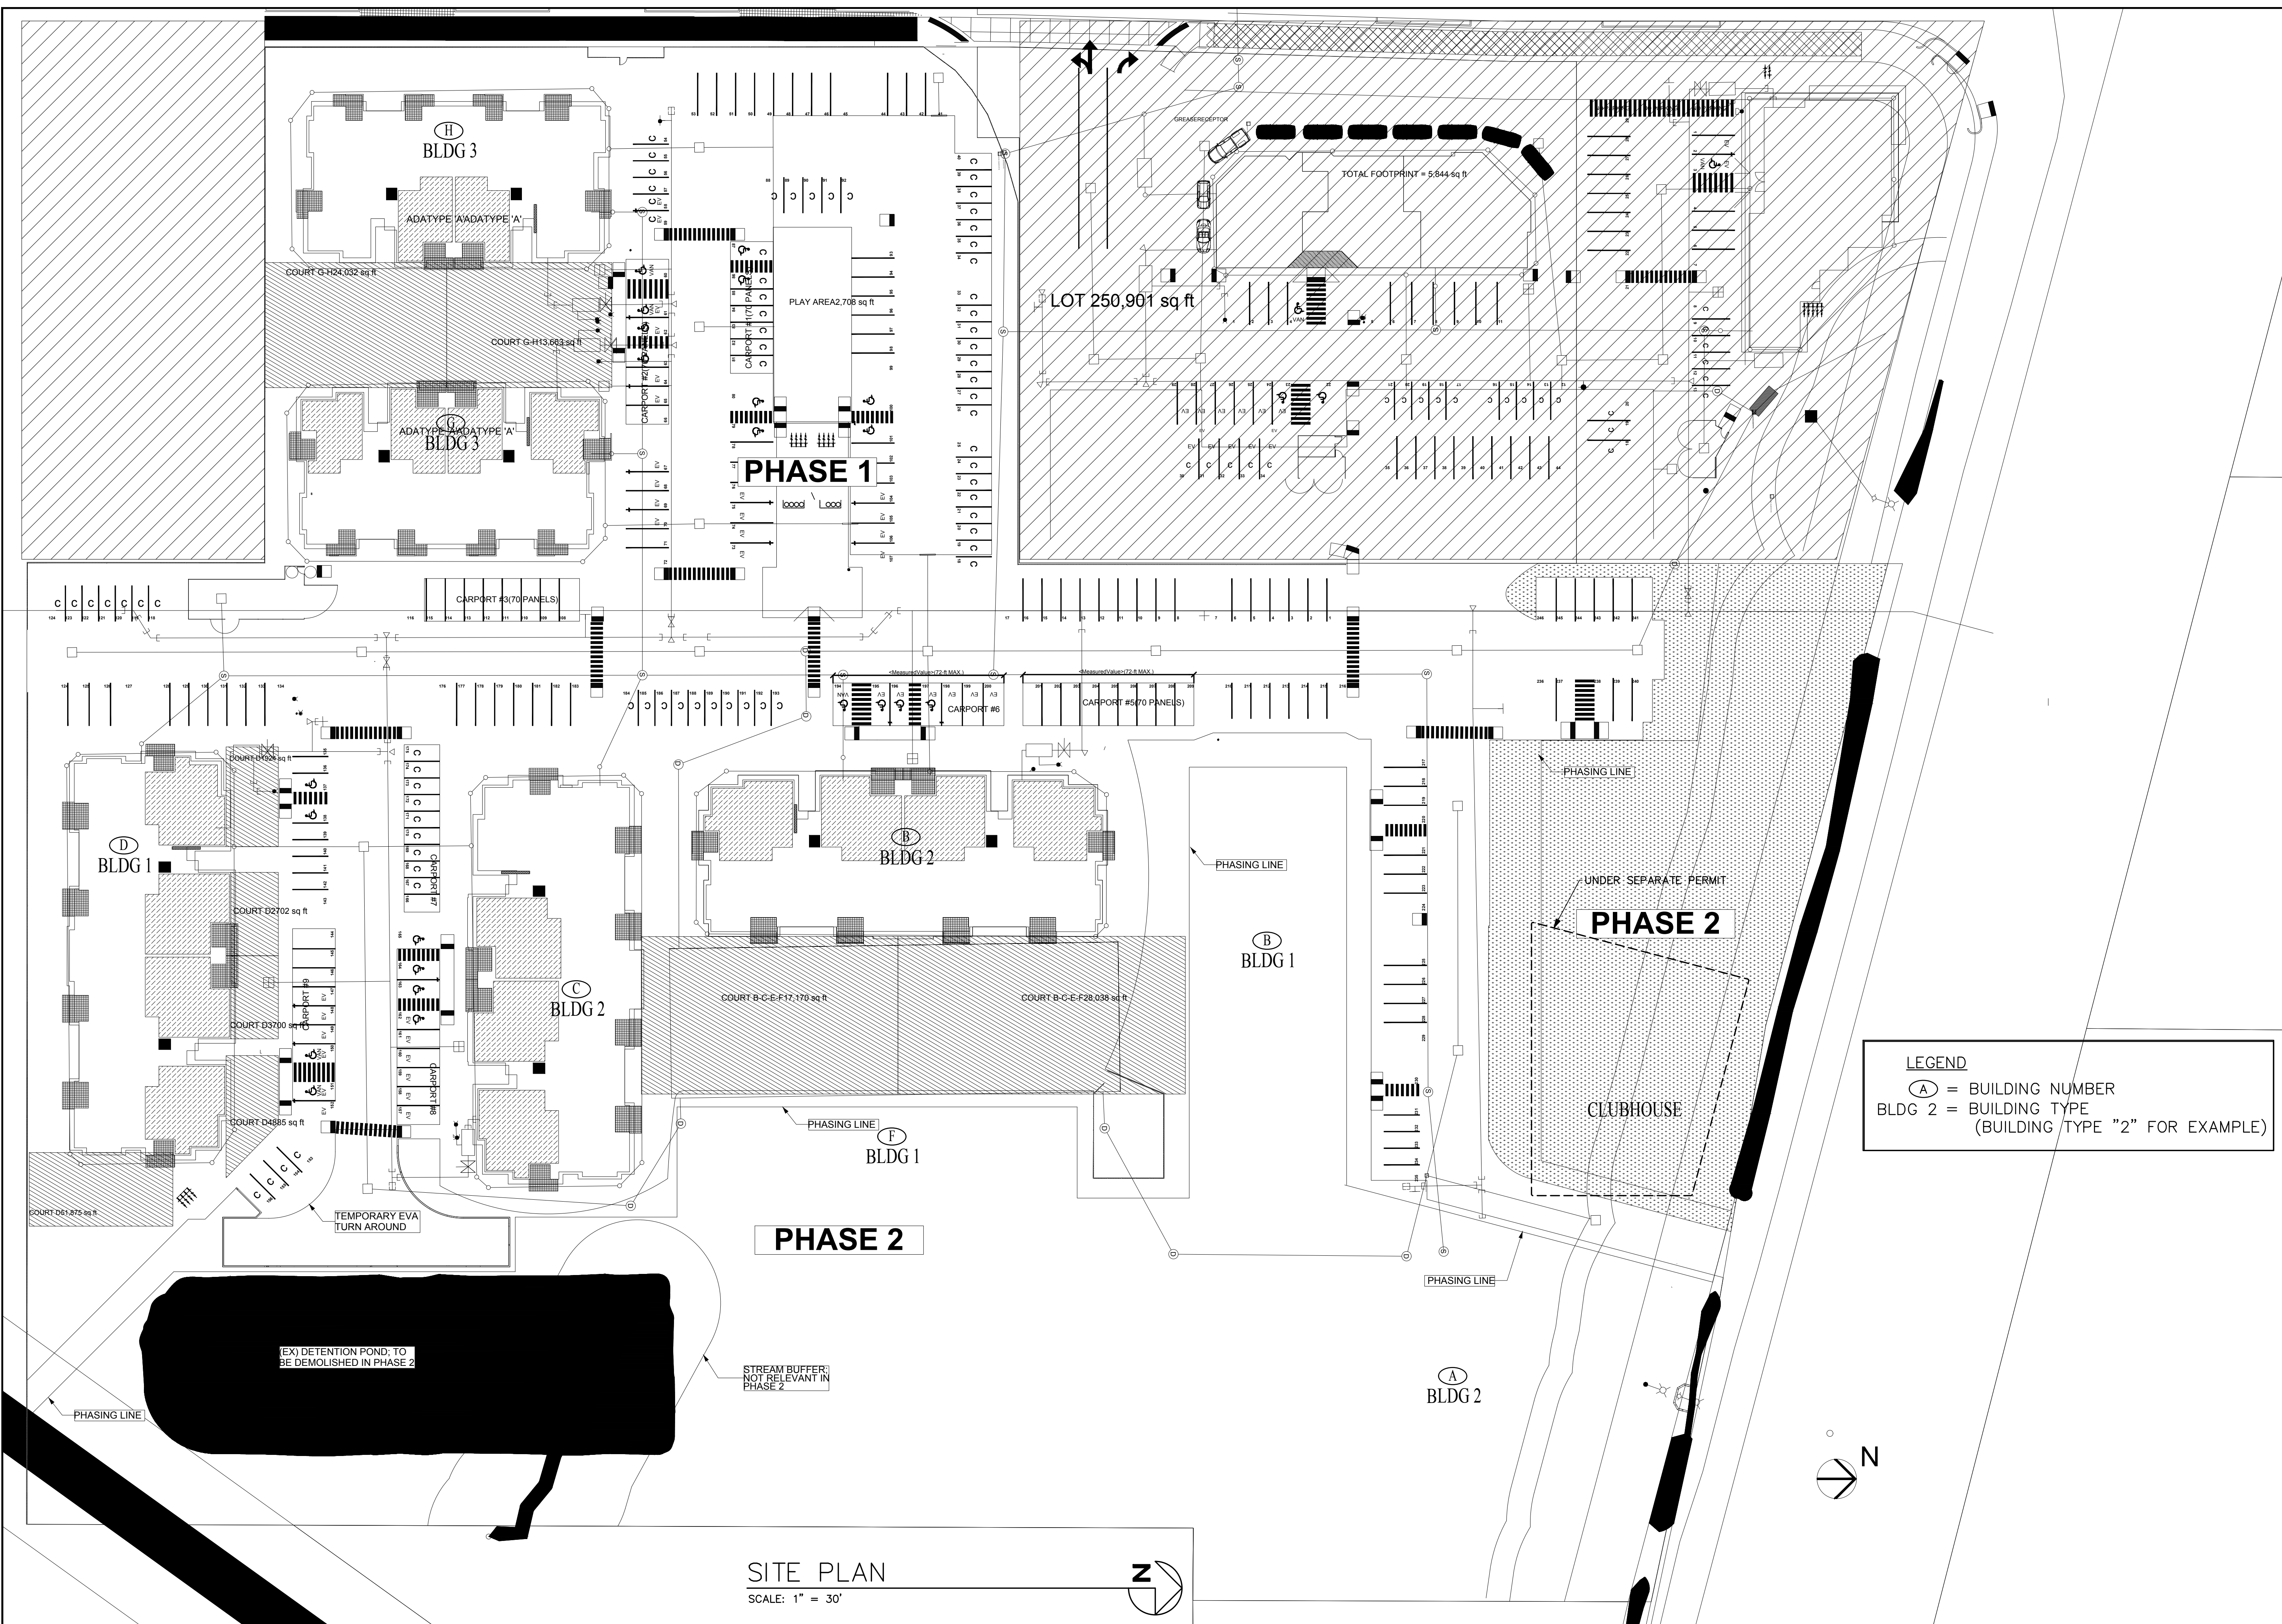


LEGEND
 (A) = BUILDING NUMBER
 BLDG 2 = BUILDING TYPE
 (BUILDING TYPE "2" FOR EXAMPLE)

PHASE 2

SITE PLAN
 SCALE: 1" = 30'

NO.	DATE	DESCRIPTION

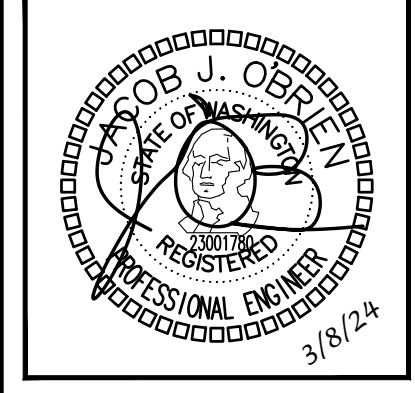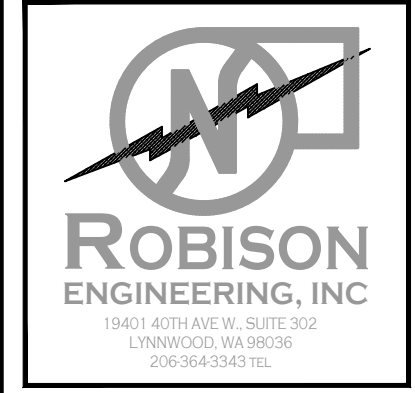

DRAWN: OP	CHECKED: JMR
DESIGNED: ABE	APPROVED: JMR

PROJECT: EAST TOWN CROSSING BUILDING F
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA


19401 ACOTHAVE W. SUITE 302
 LYNNWOOD, VA 28036
 PHONE: (202) 964-3343
 RE: PROJECT NO. 810010
 CONTACT: ARIK ESPINELLI

ROBISON ENGINEERING, INC.

DATE: 3/8/2024

SHEET TITLE: **SITE PLAN**

SHEET NO. **M1.0**

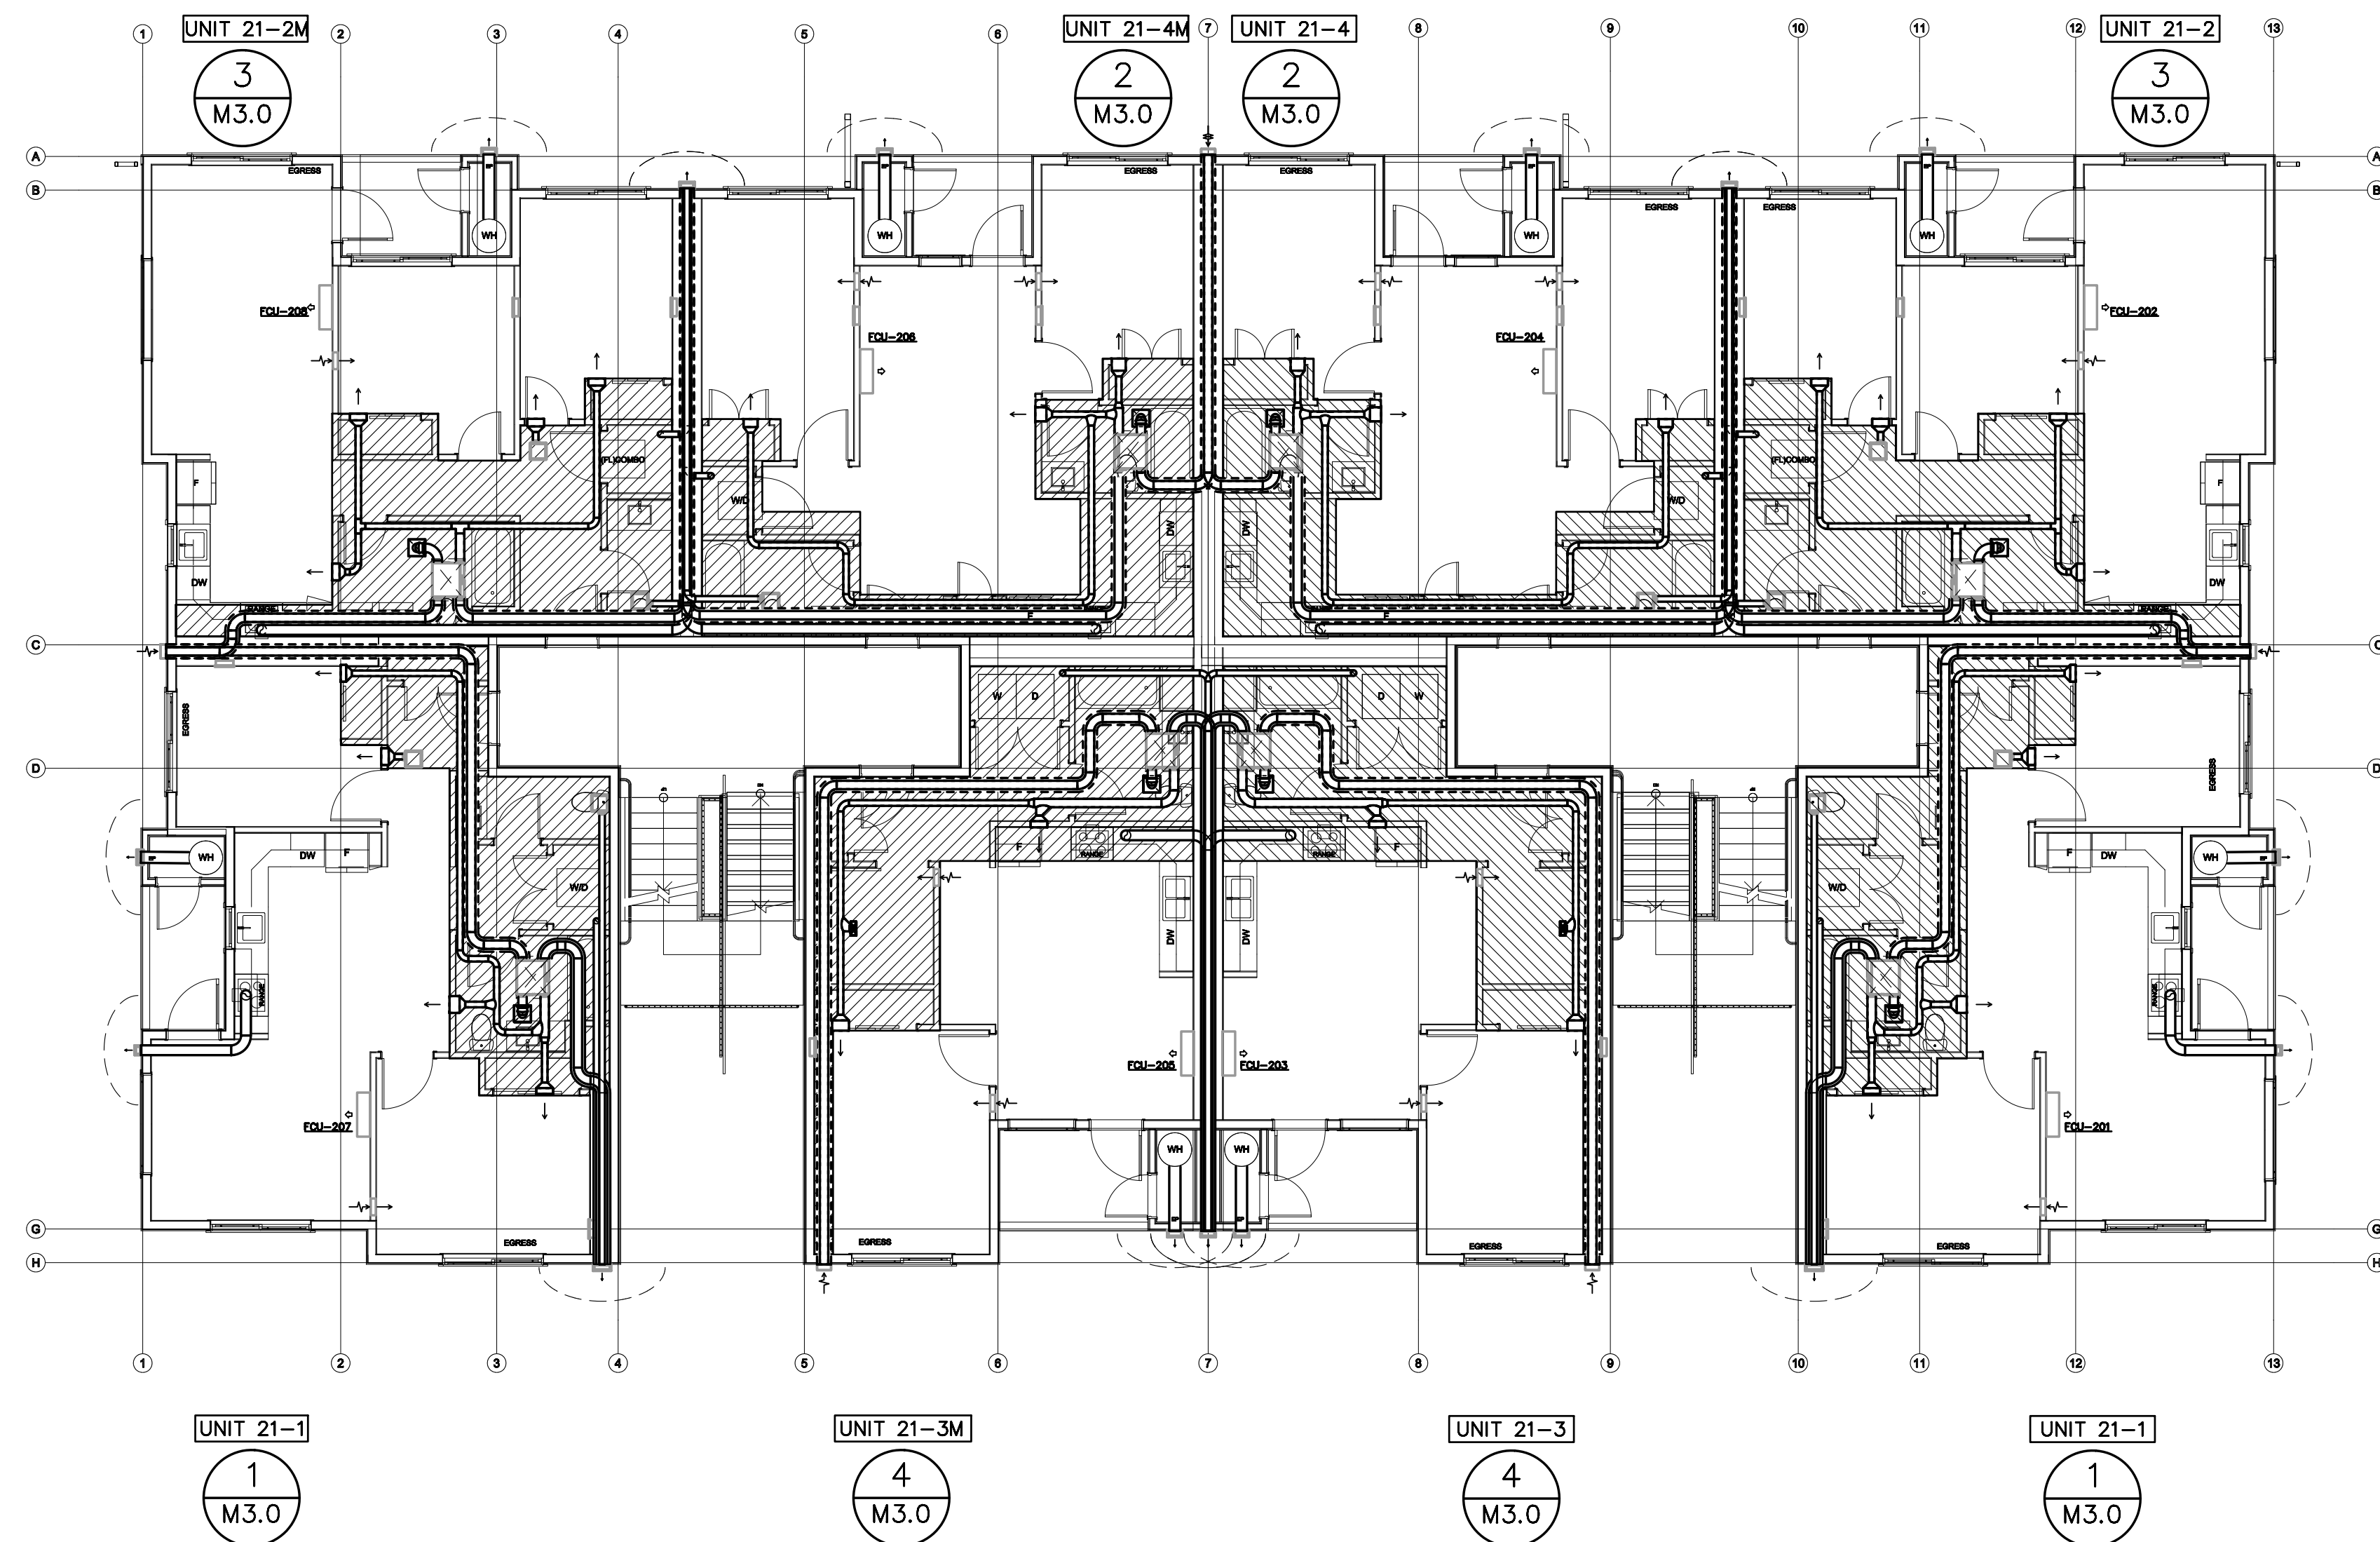

RESIDENTIAL UNIT NOTES:

UNIT A = UNIT TYPE A (FOR EXAMPLE)
 REFER TO DWG M3.0,
 DETAIL 1.


FOR DUCT SIZES WITHIN THE RESIDENTIAL
 UNITS, REFER TO THE ENLARGED UNIT
 PLANS ON DWGS M3.0.

BUILDING TYPE 1

LEVEL 2 FLOOR PLAN

SCALE: 1/8" = 1'-0"

NO.	DATE	DESCRIPTION

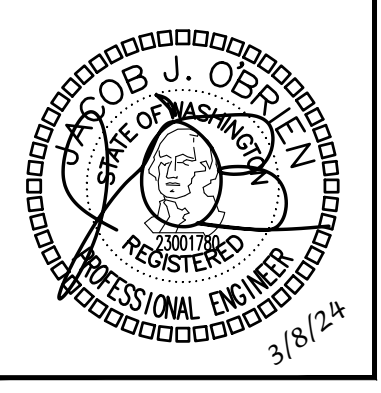

DRAWN:	OP
DESIGNED:	ABE
CHECKED:	PR
APPROVED:	JMR

PROJECT: EAST TOWN CROSSING BUILDING F
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA


19401 40TH AVE W., SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 964-3343
 RE: PROJECT NO. 810010
 CONTACT: ARK@ESPINELI

ROBISON ENGINEERING, INC.

DATE:
 3/8/2024

SHEET TITLE:
 HVAC PLAN -
 LEVEL 2

SHEET NO.
M2.1

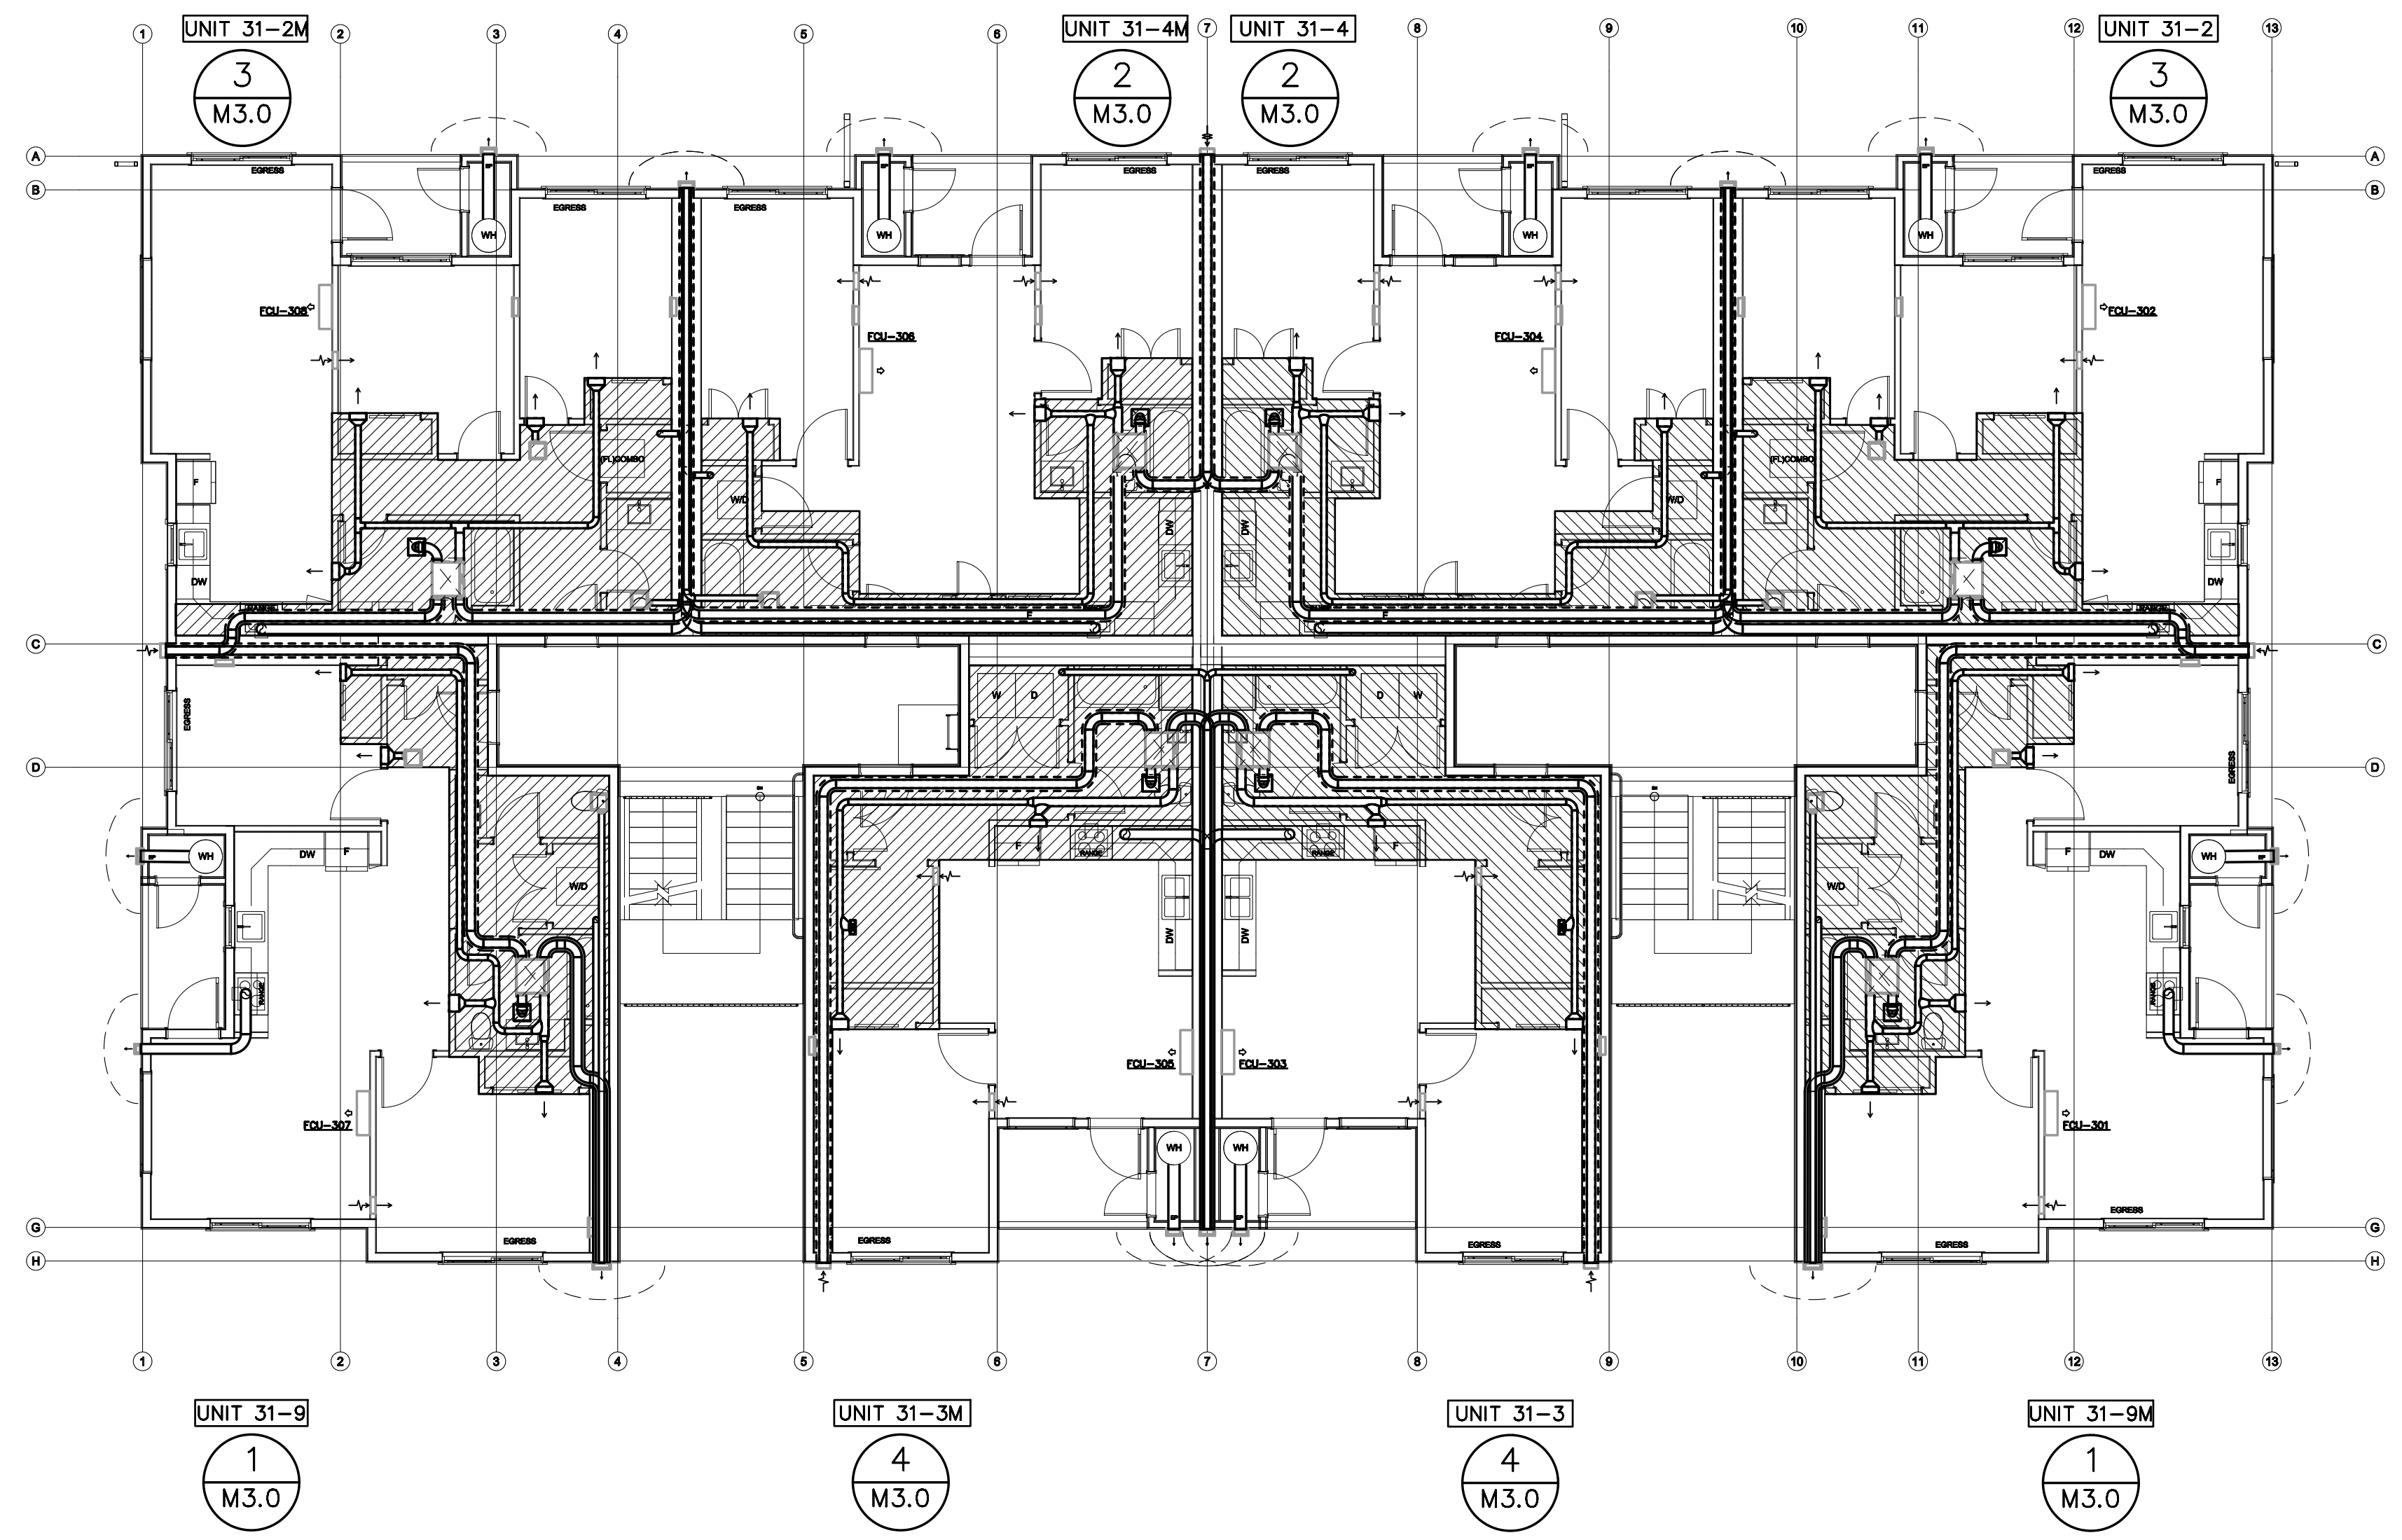

RESIDENTIAL UNIT NOTES:

UNIT A = UNIT TYPE A (FOR EXAMPLE)
 REFER TO DWG M3.0,
 DETAIL 1.


FOR DUCT SIZES WITHIN THE RESIDENTIAL
 UNITS, REFER TO THE ENLARGED UNIT
 PLANS ON DWGS M3.0.

BUILDING TYPE 1

LEVEL 3 FLOOR PLAN

SCALE: 1/8" = 1'-0"

NO.	DATE	DESCRIPTION

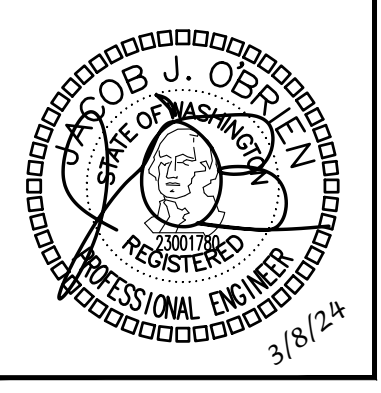

DRAWN:	OP
DESIGNED:	ABE
CHECKED:	PR
APPROVED:	JMR


PROJECT: EAST TOWN CROSSING BUILDING F
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 ACOTHAVE W., SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 964-3343
 RE: PROJECT NO. 810010
 CONTACT: ARK@ESPINELI.COM



DATE:
 3/8/2024

SHEET TITLE:
 HVAC PLAN -
 LEVEL 3

SHEET NO.
M2.2

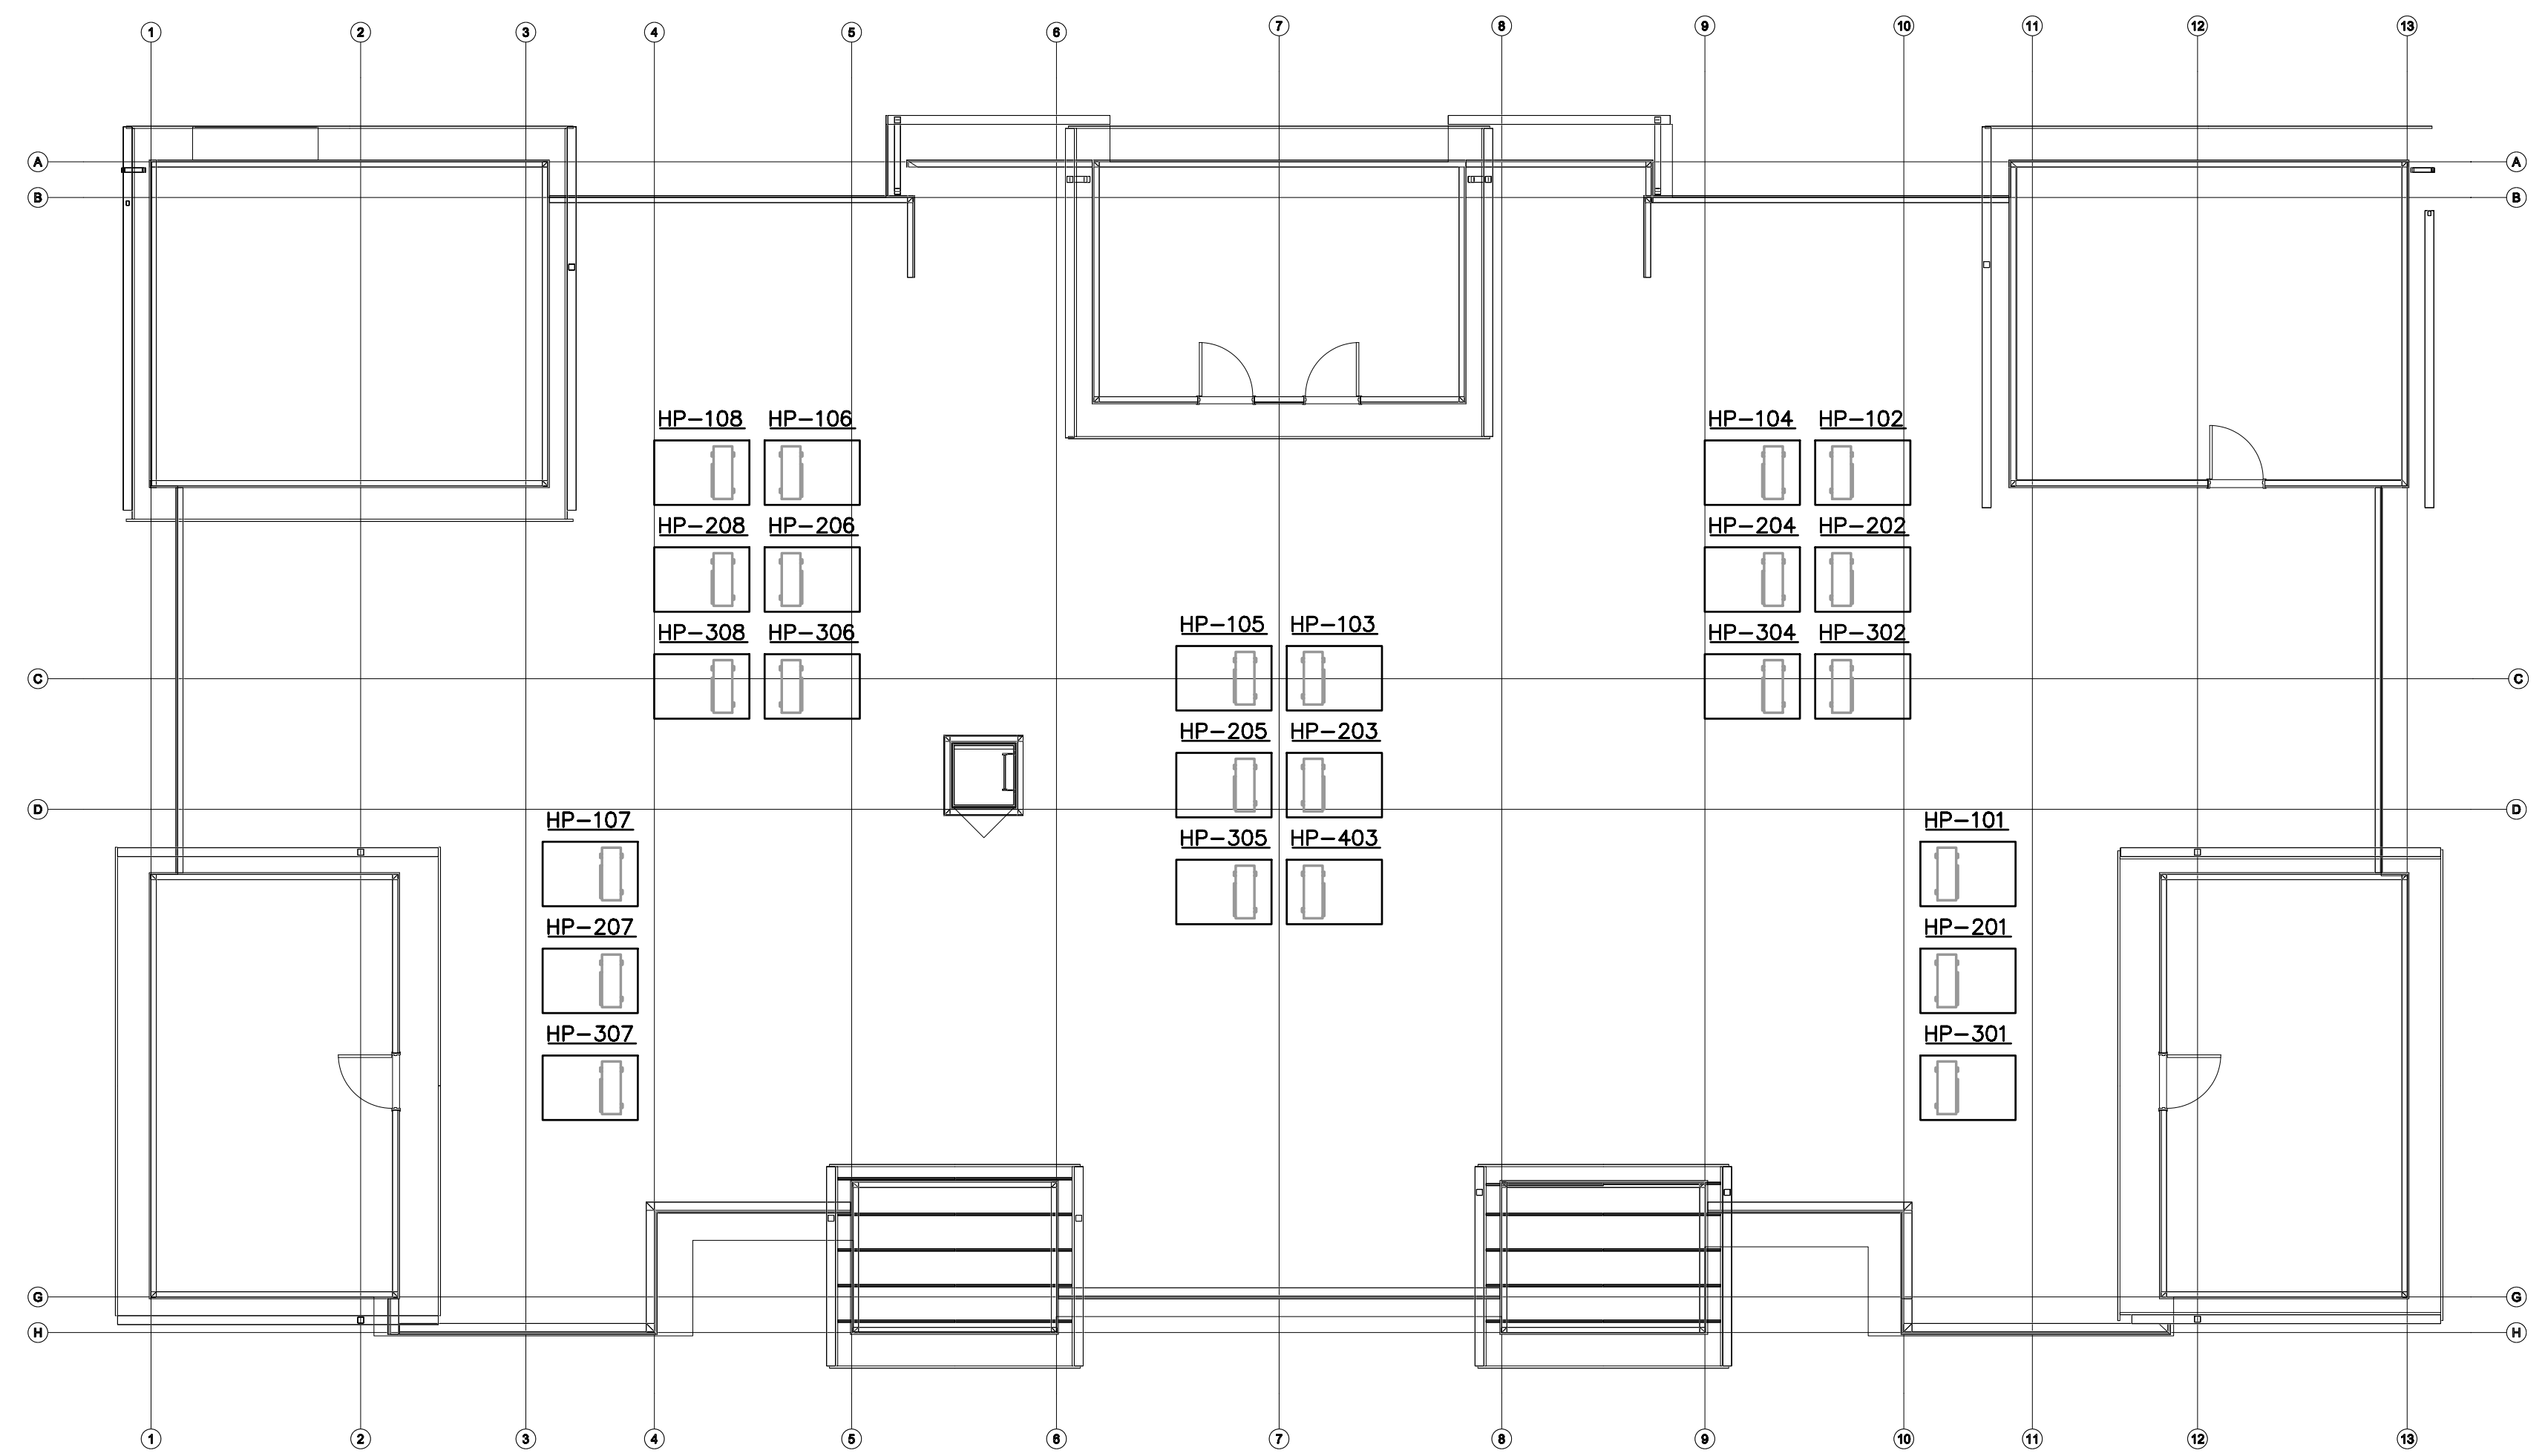

NO.	DATE	REVISIONS DESCRIPTION

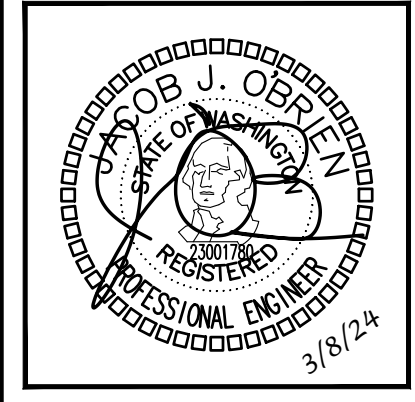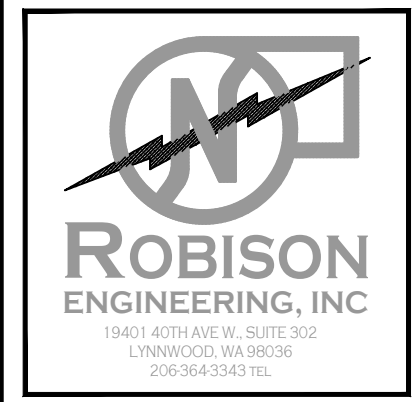

DRAWN:	OP
DESIGNED:	ABE
CHECKED:	PR
APPROVED:	JMR

PROJECT: EAST TOWN CROSSING BUILDING F
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA


19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206/834-4343
 RE/PROJECT NO.: 810010
 CONTACT: ARK/ESPINELLI

DATE:
3/8/2024


SHEET TITLE:
HVAC PLAN -
ROOF

SHEET NO.
M2.3


BUILDING TYPE 1
 ROOF FLOOR PLAN
 SCALE: 1/8" = 1'-0"

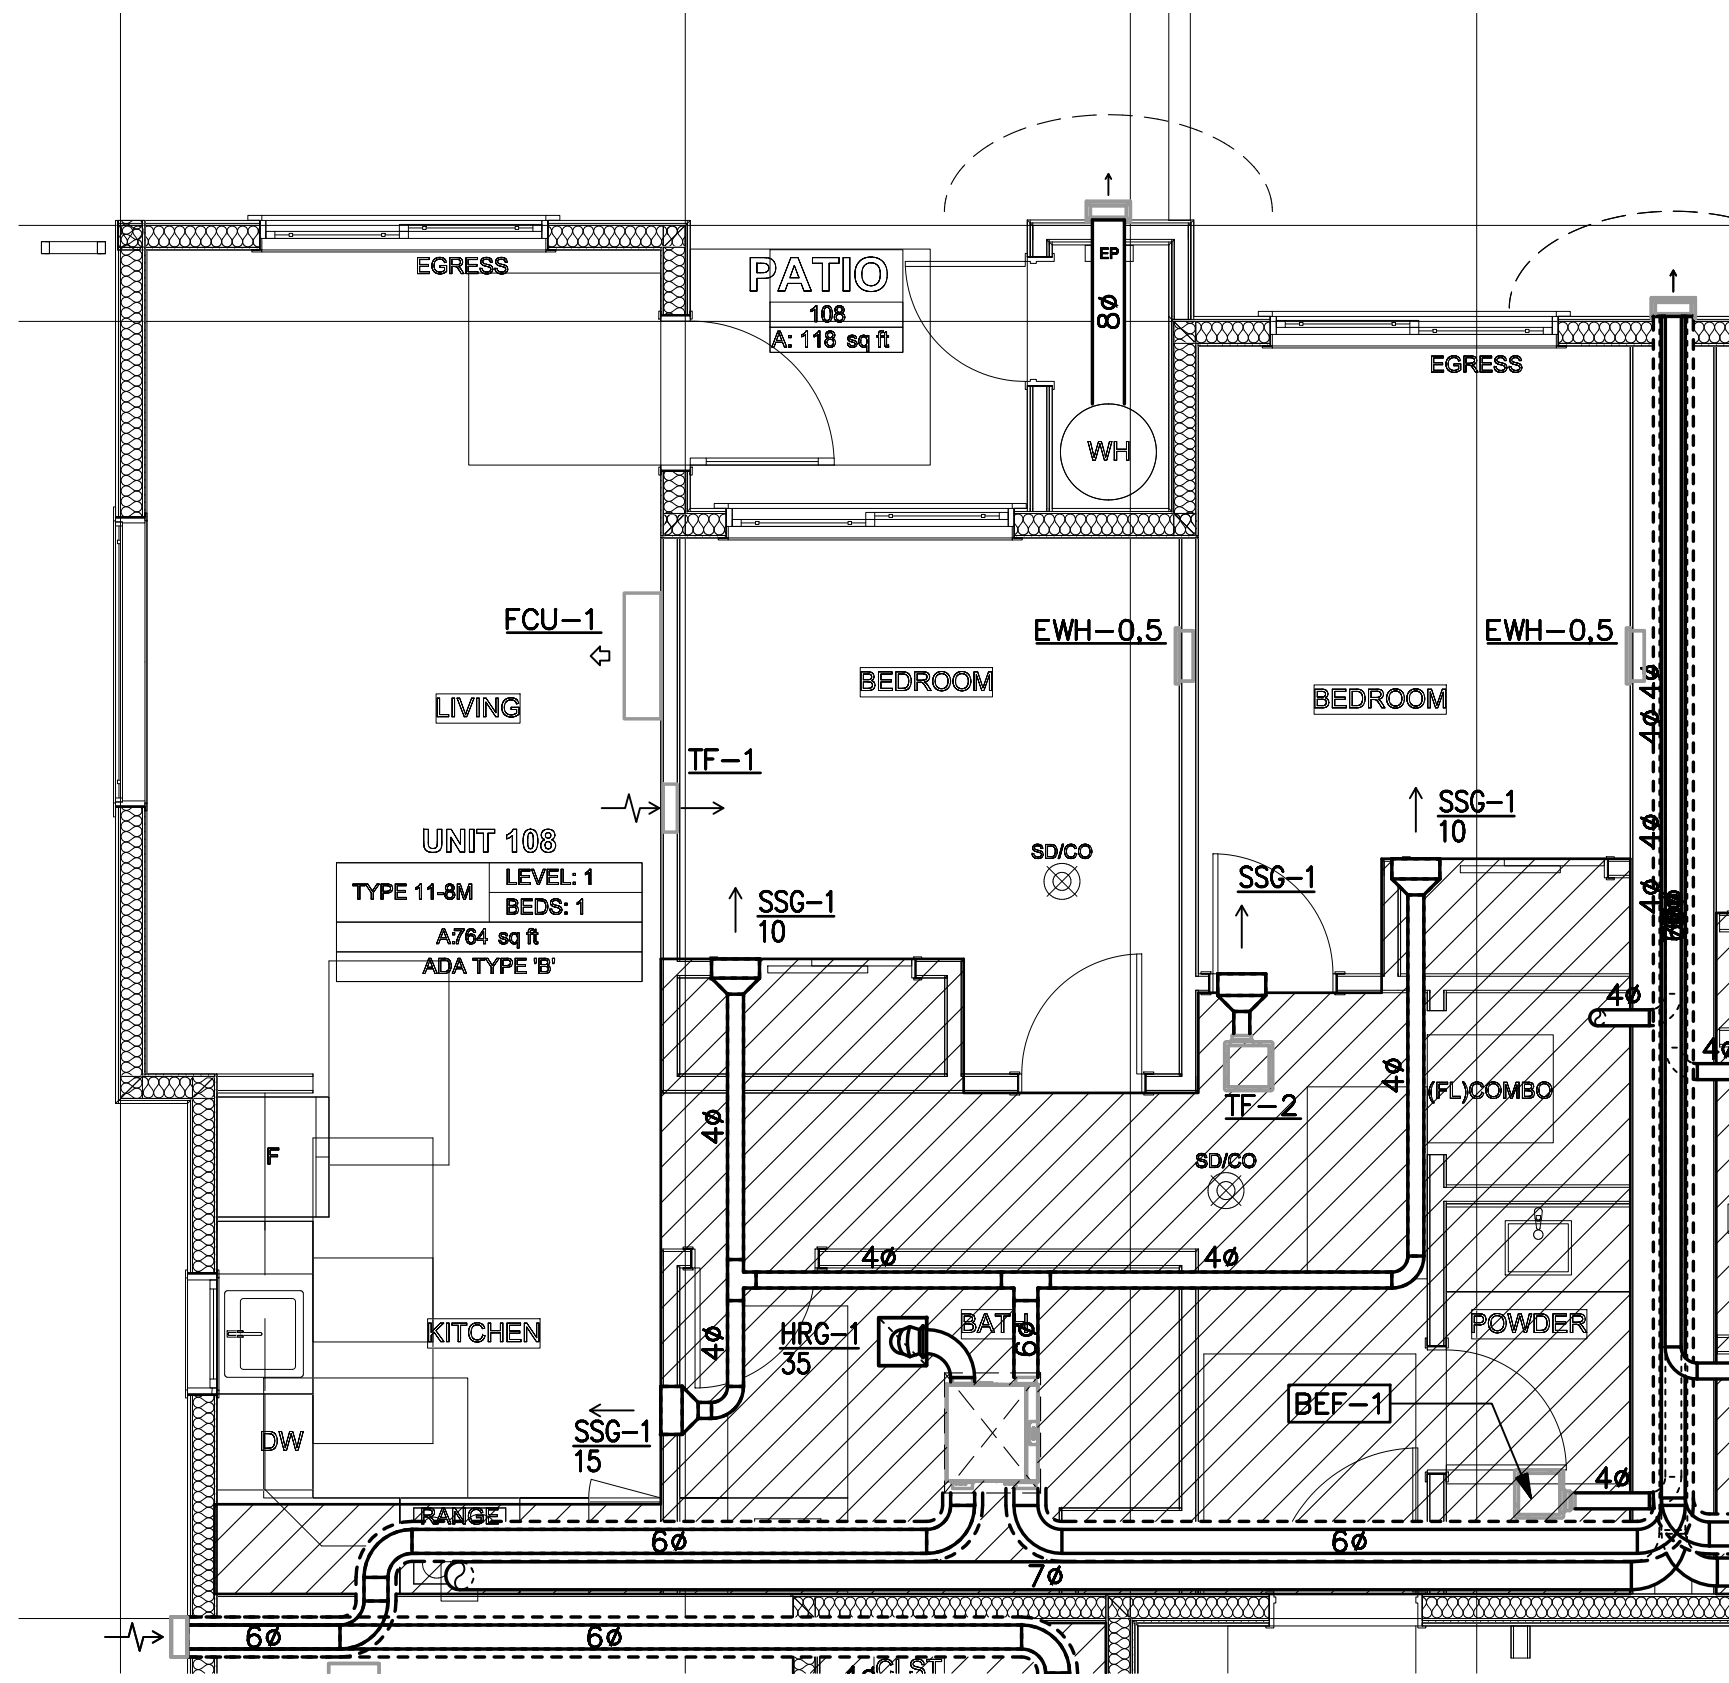


UNIT 11-8, 11-8M, 21-2, 21-2M, 31-2, 31-2M
 ENLARGED PLAN
 SCALE: 1/4" = 1'-0"
 3
 M3.0

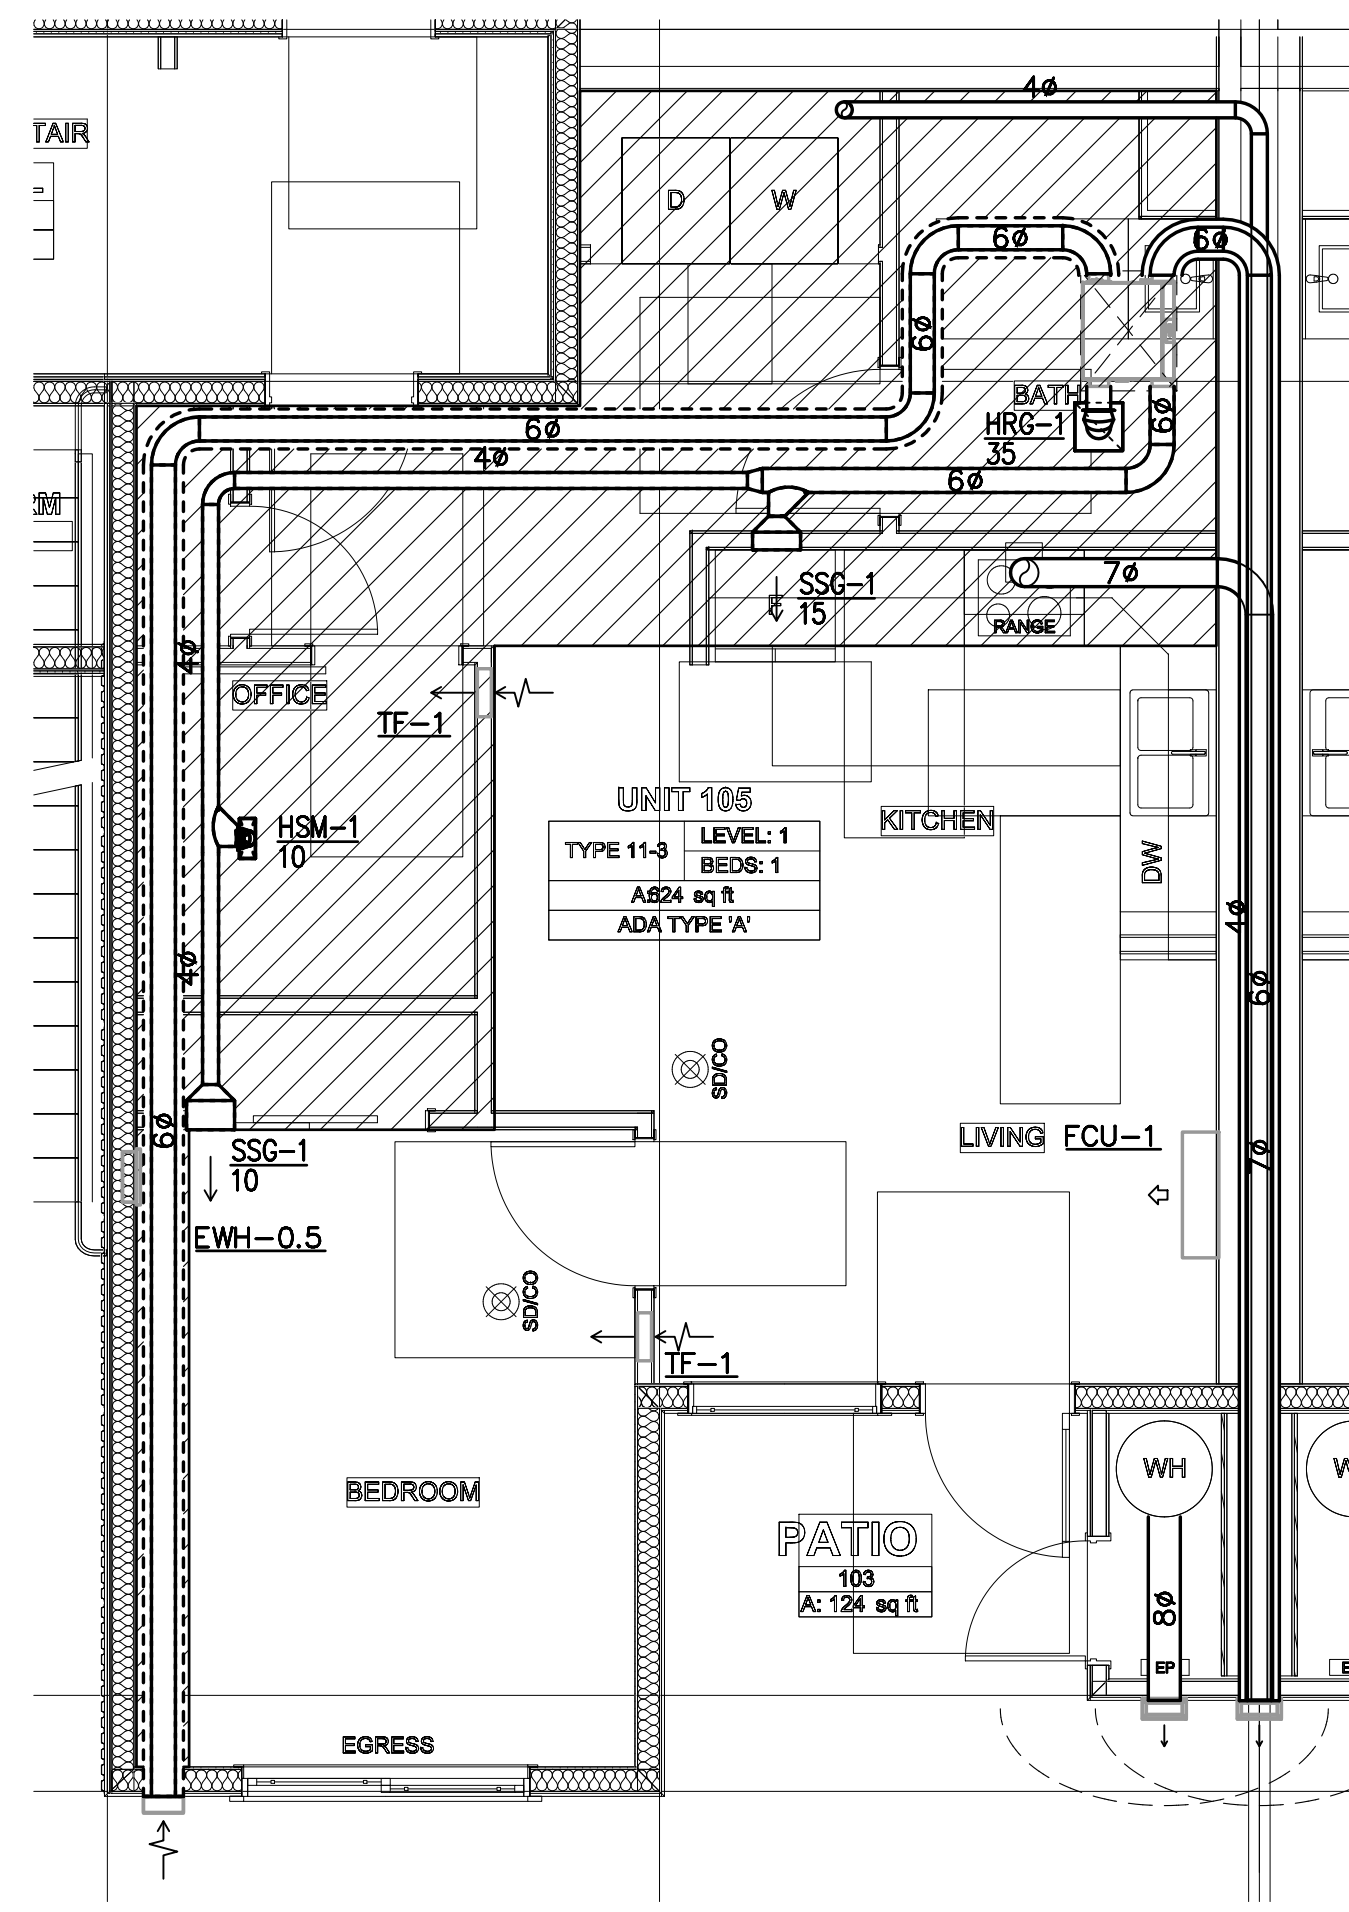

UNIT 11-3, 11-3M, 21-3, 21-3M, 31-3, 31-3M
 ENLARGED PLAN
 SCALE: 1/4" = 1'-0"
 4
 M3.0

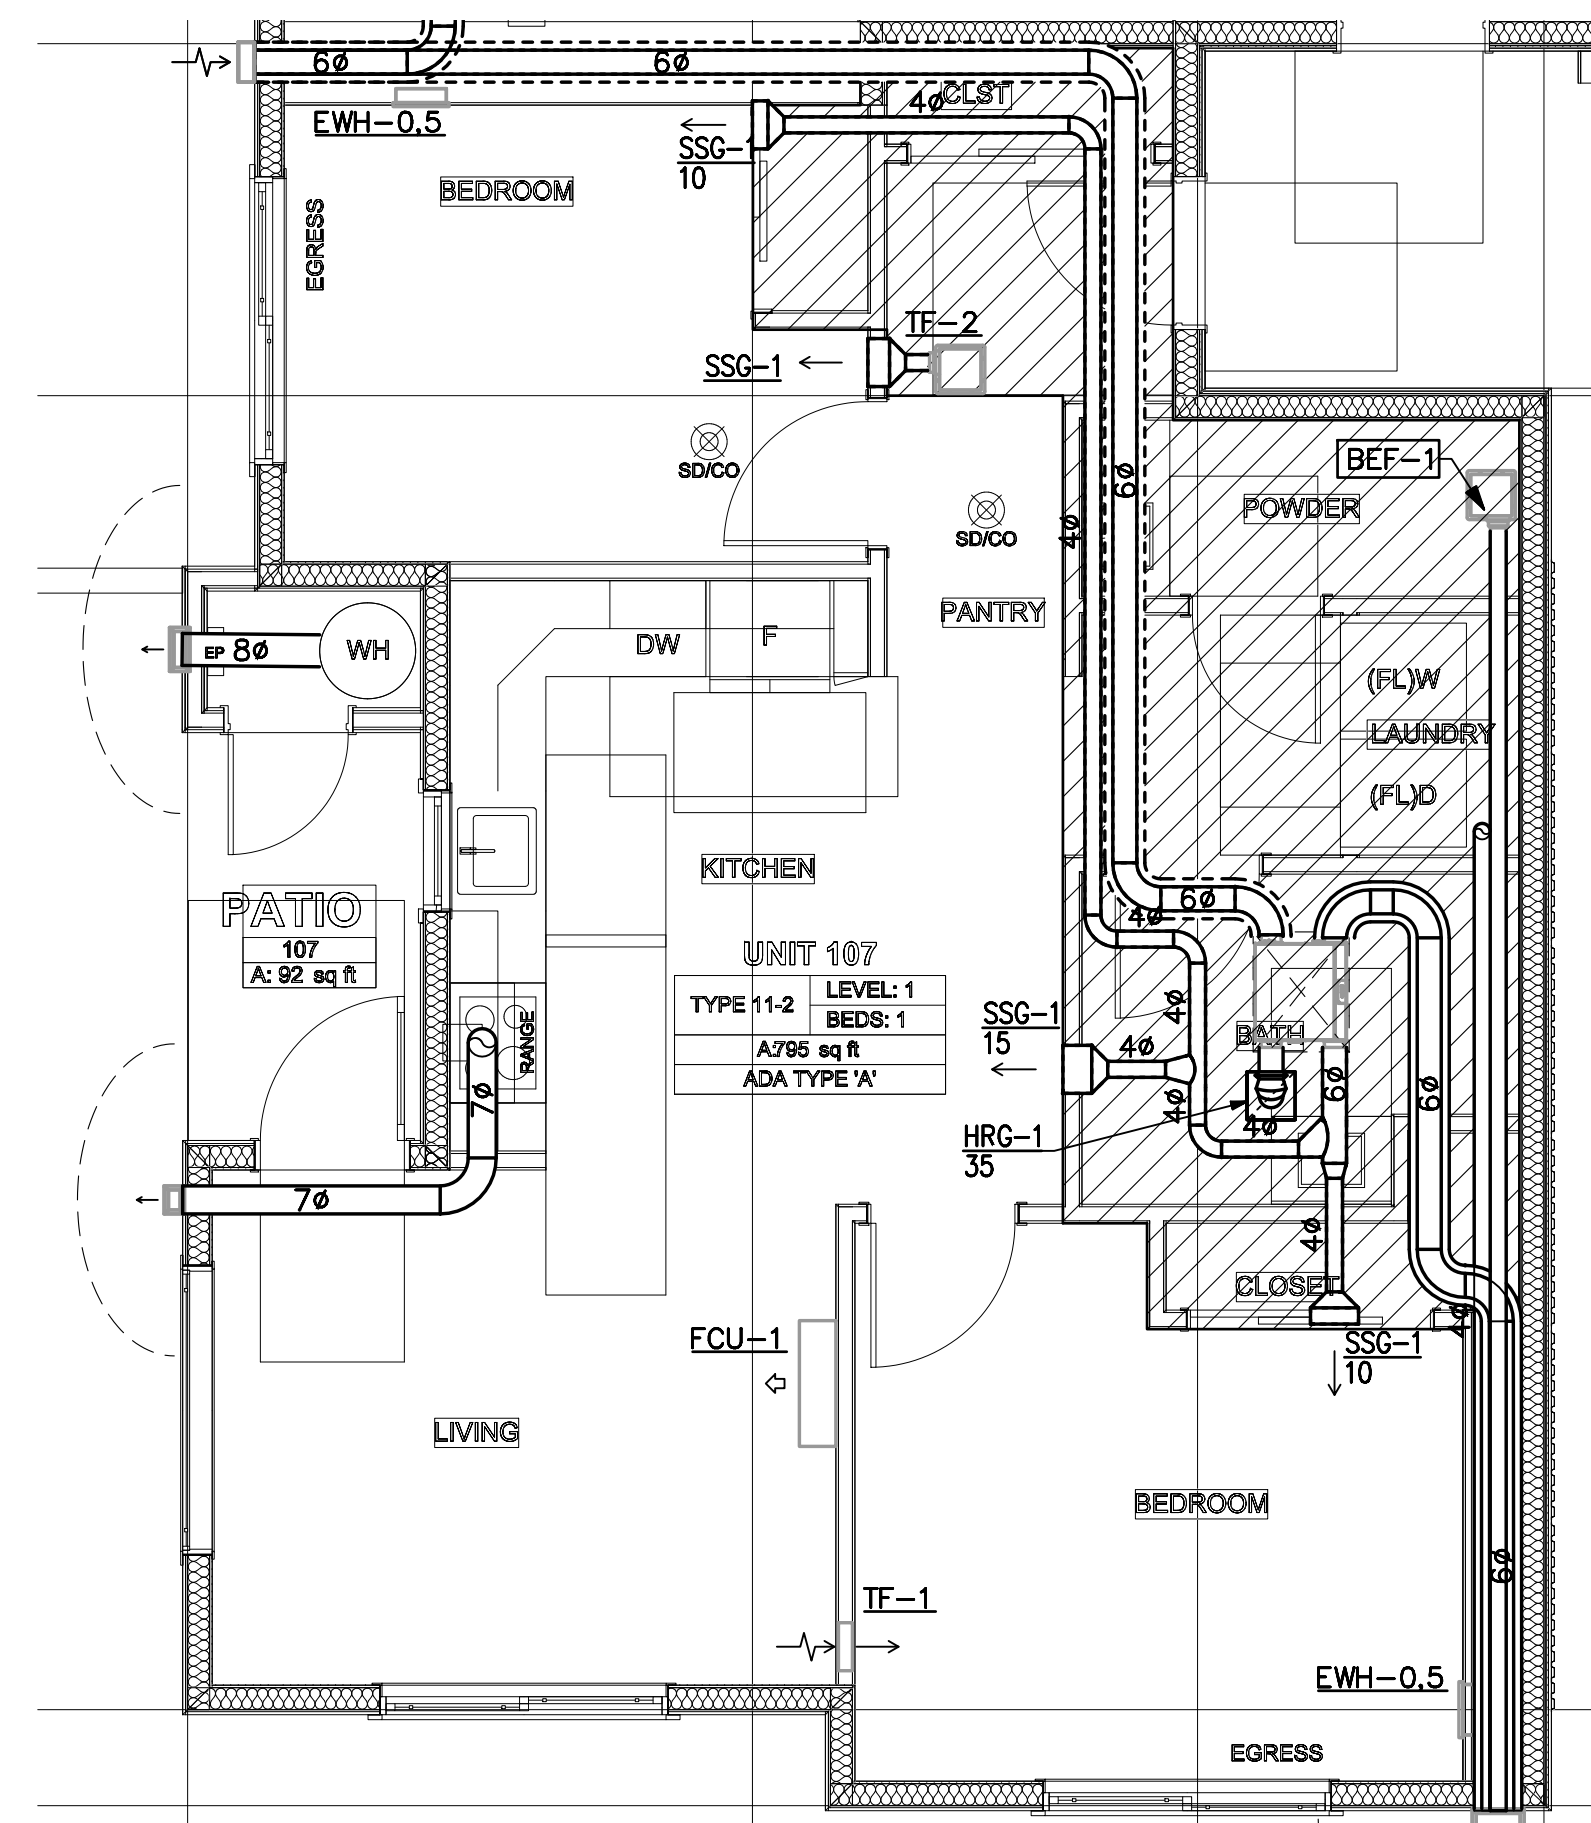

UNIT 11-2, 11-2M, 21-1, 21-1M, 31-1, 31-1M
 ENLARGED PLAN
 SCALE: 1/4" = 1'-0"
 1
 M3.0

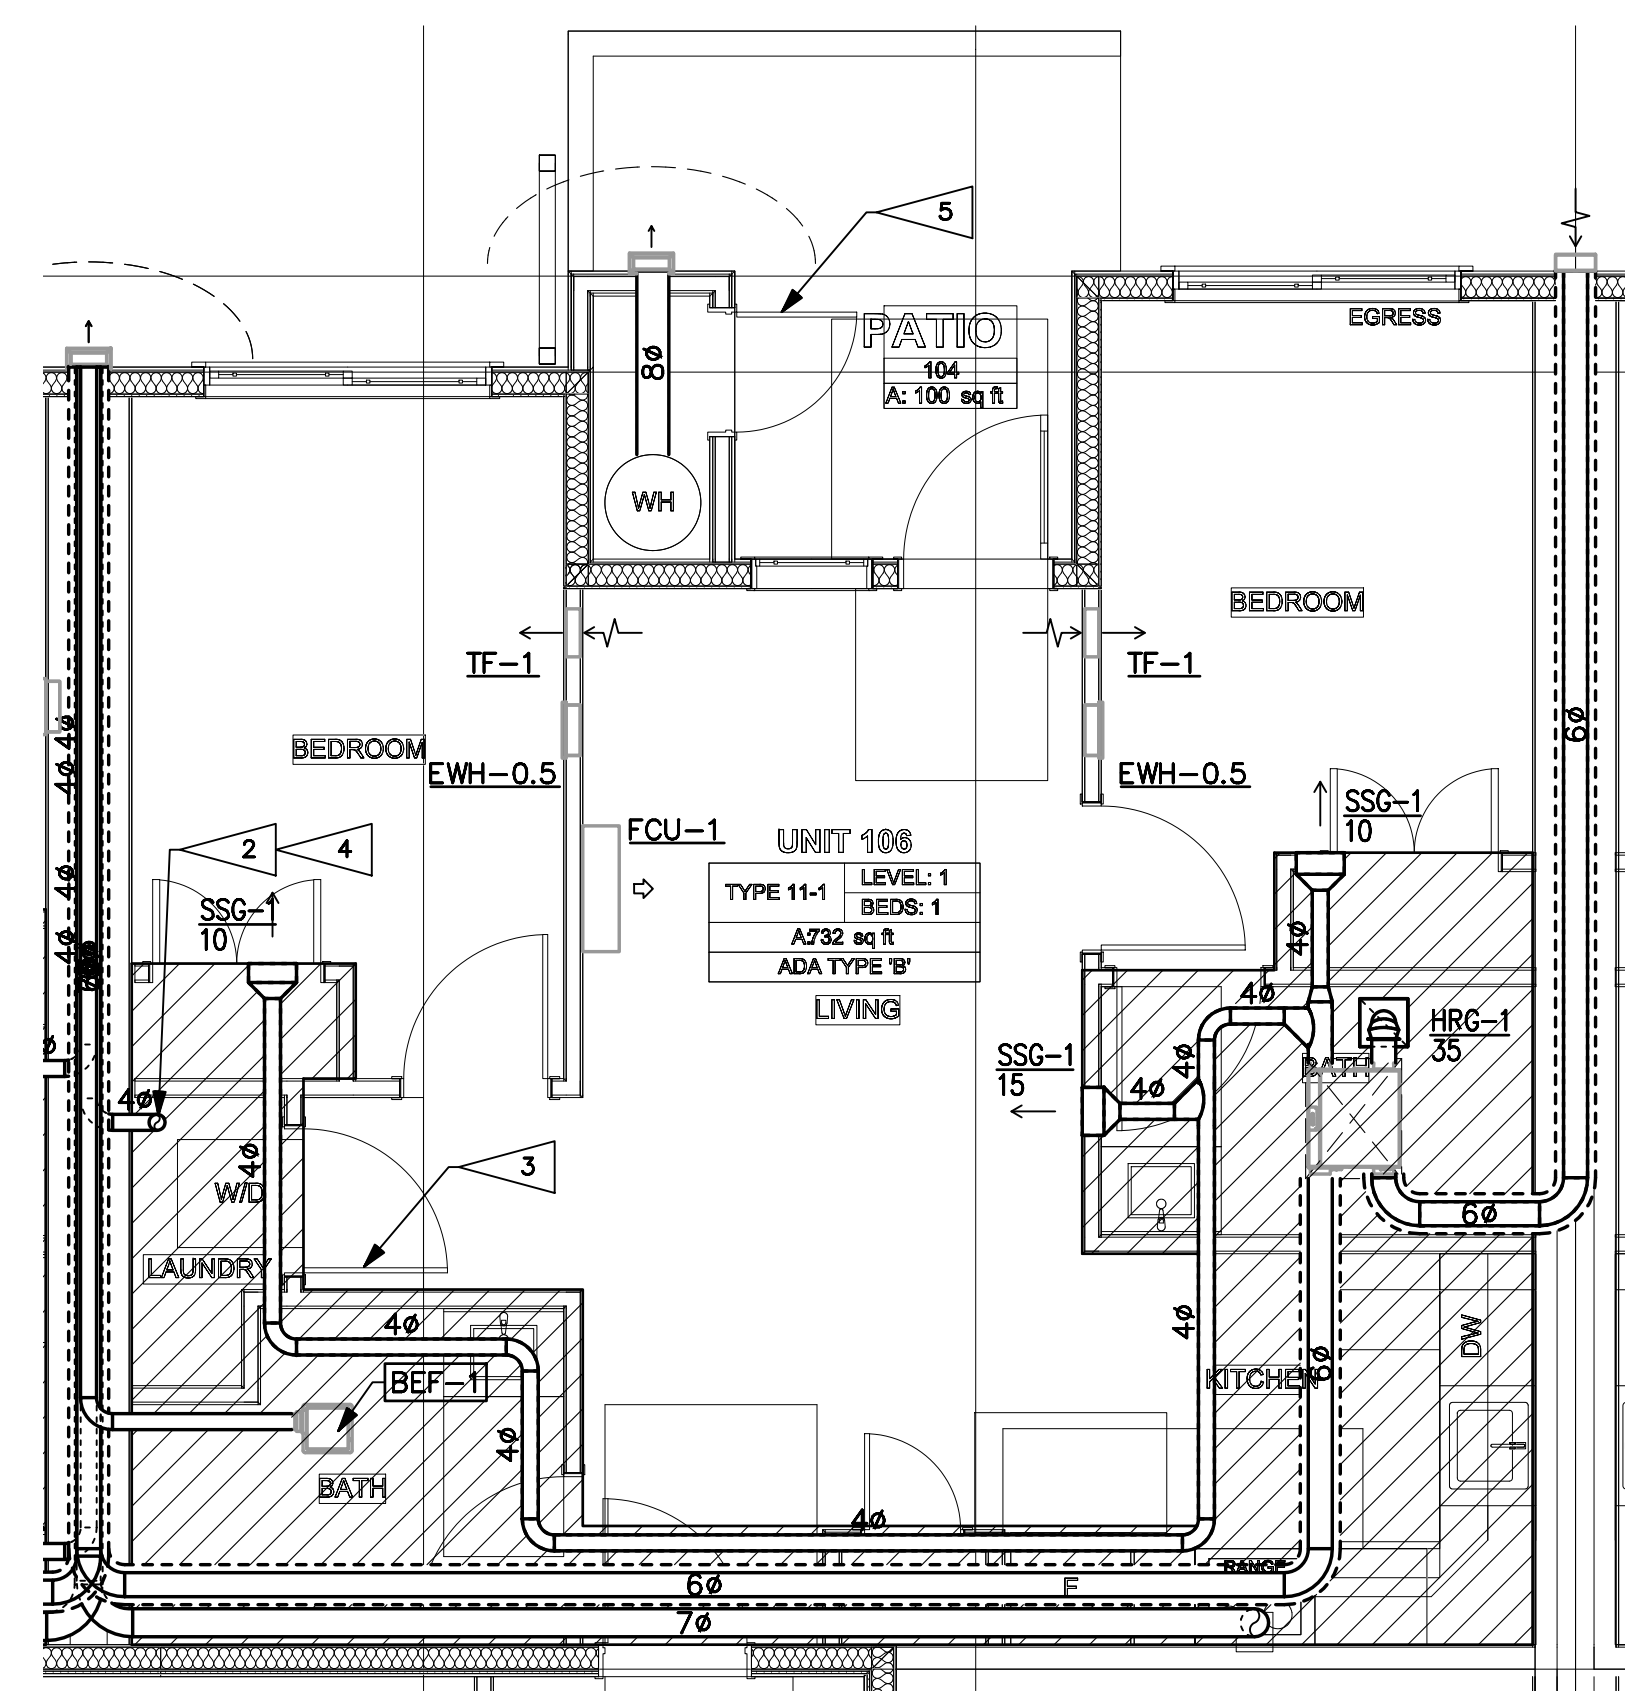

UNIT 11-1, 11-1M, 21-4, 21-4M, 31-4, 31-4M
 ENLARGED PLAN
 SCALE: 1/4" = 1'-0"
 2
 M3.0

RESIDENTIAL UNIT NOTES:

1. PENETRATIONS OF THE RATED WALL ASSEMBLIES SHALL BE PROTECTED IN ACCORDANCE WITH IBC SECTION 717. REFER TO ARCHITECTURAL PLANS FOR PENETRATION DETAILS.
2. PER OWNER, THE FOLLOWING RANGE HOODS ARE BEING INSTALLED: STANDARD UNITS (MICRO/HOOD COMBO): FRIGIDAIRE LFMV1846VF ADA UNITS (HOOD ONLY): GE JXV3240DJWW PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS, DUCT CONNECTION TO HOODS ARE 6". MINIMUM SIZE ROUND DUCT FOR HOOD VENTING SHALL BE 7".
3. DRYER VENTING: PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS, THE MAXIMUM LENGTH OF THE DRYER VENTS IS AS FOLLOWS (REFER TO DWG M4.0, DETAIL 1):

STANDARD DRYER:
GE GU27ESM

NUMBER OF 90° ELBOWS OR TURNS	MAXIMUM LENGTH (FT)
0	200
1	185
2	175
3	165
4	155
5	145



ADA DRYER:
GE GFV55ESSN

NUMBER OF 90° ELBOWS OR TURNS	MAXIMUM LENGTH (FT)
0	200
1	185
2	175
3	165
4	155

FLAG NOTES: #

1. POC RANGE HOOD.
2. POC DRYER.
3. LOUVERED DOOR. REFER TO ARCHITECTURAL PLANS FOR DETAILS.
4. DRYER EXHAUST VENT SHALL BE PROTECTED WITH FIRE WRAP FROM DRYER TO EXTERIOR WALL TERMINATION POINT. REFER TO DWG M401, DETAIL 1 FOR FIRE WRAP DETAILS. FIRE WRAP SHALL BE UNIFRAX FYREWRAP DPS.
5. LOUVERED DOOR. PROVIDE LOUVER WITH MINIMUM 130SQIN. LOUVER TO BE INSTALLED PER MANUFACTURER.

NO.	DATE	DESCRIPTION

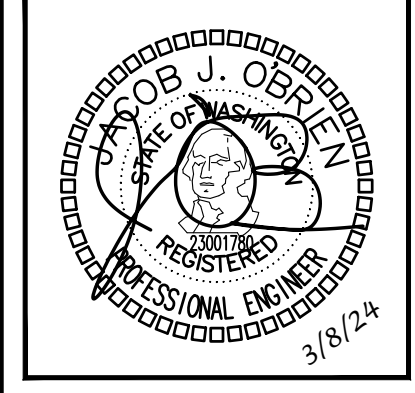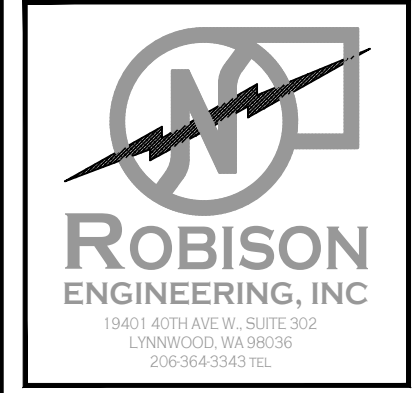

DRAWN: OP	DESIGNED: ABE	CHECKED: PR	APPROVED: JMR
-----------	---------------	-------------	---------------

PROJECT: EAST TOWN CROSSING BUILDING F
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 ACOTWAYE W. SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 964-3343
 RE: PROJECT NO.: 810010
 CONTACT: ARK.ESPINELLI

ROBISON ENGINEERING, INC.

DATE:
3/8/2024

SHEET TITLE:
HVAC ENLARGED PLANS

SHEET NO.
M3.0

ADA DRYER

GFV55ESSN

GE® Long Vent 7.8 cu. ft. Capacity Front Load Electric Dryer

DIMENSIONS AND INSTALLATION INFORMATION (IN INCHES)


ELECTRIC DRYER RATING	
120V/240V	5600W, 25A, 60Hz
120V/208V	4300W, 23A, 60Hz

EXHAUST OPTIONS: 4-way via rear, right, left and bottom.

CIRCUIT REQUIREMENTS: An individual, properly grounded branch circuit, protected by a 30-amp circuit breaker or a time-delay fuse, is required.

NOTE: Dryer wall outlet must be located within 36" of service cord entry and accessible when dryer is mounted in position.

INSTALLATION INFORMATION: For complete information, see installation instructions packed with your dryer.

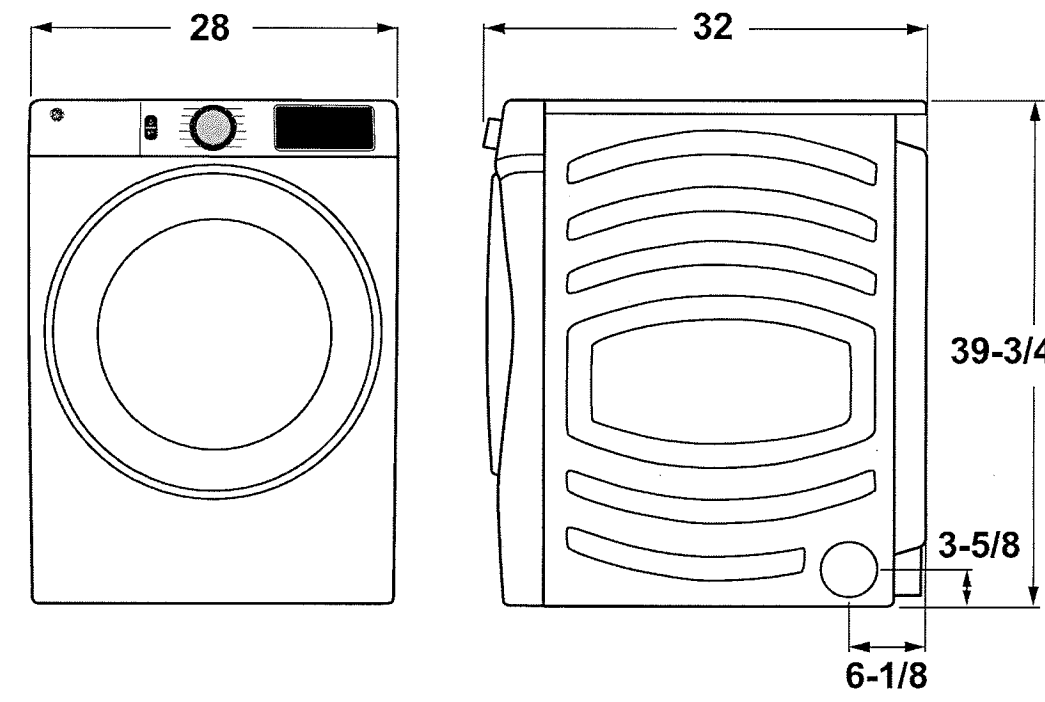

For answers to your Monogram, GE Café® Series, GE Profile® Series or GE Appliances product questions, visit our website at geappliances.com or call GE Answer Center® Service, 800.626.2000.



Specification Revised 11/19

GFV55ESSN

GE® Long Vent 7.8 cu. ft. Capacity Front Load Electric Dryer

DRYER EXHAUSTING INFORMATION - METAL DUCT ONLY

For complete information, see installation instructions packed with your dryer.

DUCTING MATERIALS: For best performance, this dryer should be vented with 4" diameter all rigid metal exhaust duct. If rigid metal duct cannot be used, then UL-listed flexible metal (semi-rigid) ducting can be used (Kit WX08X10077). In special installations, it may be necessary to connect the dryer to the house vent using a flexible metal (foil-type) duct. A UL-listed flexible metal (foil-type) duct may be used ONLY in installations where rigid metal or flexible metal (semi-rigid) ducting cannot be used AND where a 4" diameter can be maintained throughout the entire length of the transition duct. Please see installation instruction packed with your dryer for complete instructions when using flexible metal (foil type) ducting.

EXHAUST LENGTH CALCULATION:

- Determine the number of 90° turns needed for your installation. If you exhaust to the side or bottom of dryer, add one turn.
- The maximum length of 4" rigid (aluminum or galvanized) duct which can be tolerated is shown in the table.

A turn of 45° or less may be ignored. Two 45° turns within the duct length should be treated as a 90° elbow.


A turn over 45° should be treated as a 90° elbow. Dryers must be exhausted to the outside.

CAUTION: For personal safety do not terminate exhaust into a chimney, under any enclosed house floor (crawl space), or into an attic, since the accumulated lint could create a fire hazard or moisture could cause damage. Never terminate the exhaust into a common duct or plenum with a kitchen exhaust, since the combination of lint and grease could create a fire hazard.

Exhaust ducts should be terminated in a dampered wall cap to prevent back drafts, bird nesting, etc. The wall cap must also be located at least 12" above the ground or any other obstruction with the opening pointed down.

FOR MORE INFORMATION ON VENTING KITS AND ACCESSORIES, PLEASE CALL 1-800-GE-CARES.

Domestic dryer models	Number of 90° turns	Best performance Maximum length of 4" dia. rigid metal duct Exhaust hood type	
		A 4" opening	B 2-1/2" opening
	0	200 ft.	175 ft.
	1	185 ft.	165 ft.
	2	175 ft.	155 ft.
	3	165 ft.	145 ft.
	4	155 ft.	135 ft.

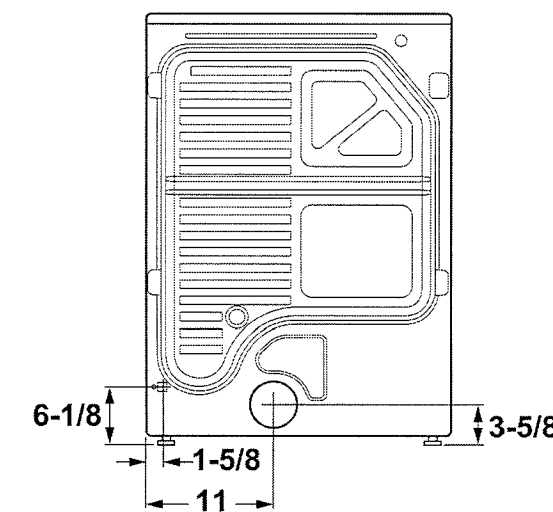

For answers to your Monogram, GE Café® Series, GE Profile® Series or GE Appliances product questions, visit our website at geappliances.com or call GE Answer Center® Service, 800.626.2000.



Specification Revised 11/19

STANDARD DRYER

GUV27ESSM

GE® Unitized Spacemaker® 3.8 DOE Cu. Ft. Stainless Steel Washer and 5.9 Cu. Ft. Long Vent Electric Dryer


DIMENSIONS AND INSTALLATION INFORMATION (IN INCHES)

ELECTRICAL REQUIREMENTS: This appliance should be connected to an individual, properly-grounded branch circuit with 120/240V or 120/208V single-phase 60 Hz electrical service and should be protected by 30-amp time-delay fuses or circuit breakers KW Rating per voltage (240/208). This appliance is manufactured with neutral connected to the frame. Power cord should be purchased separately. Dryers must be exhausted to the outside.

INSTALLATION INFORMATION: For complete information, see installation instructions packed with the product.

Installation Instructions

27" NOMINAL PRODUCT DIMENSIONS

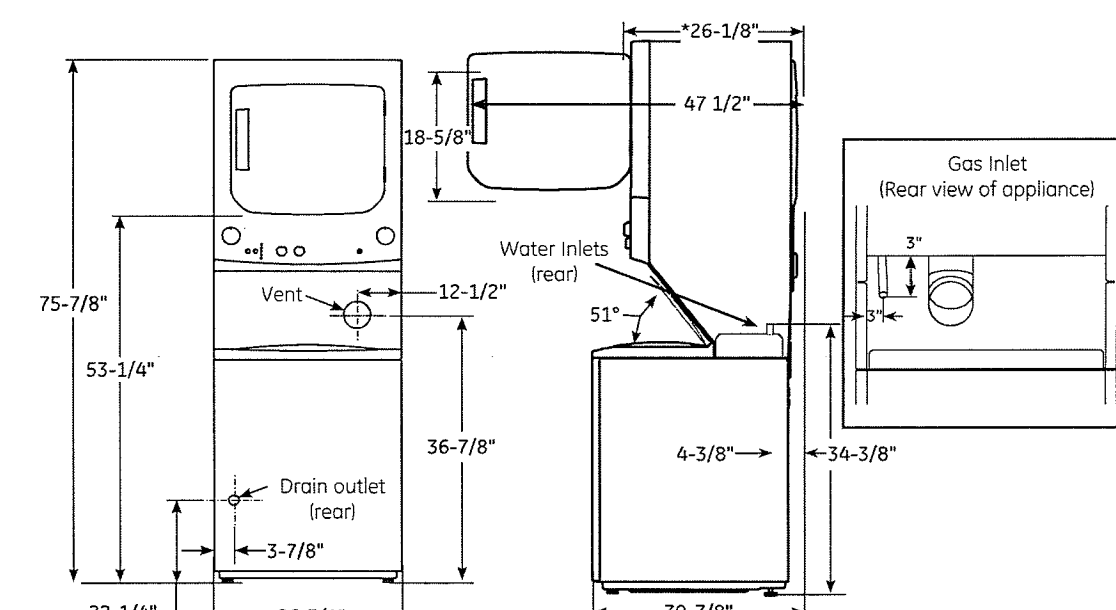

* Dimension represents door closed including handle and knobs.
NOTE: With feet set at mid position, feet can be adjusted +/- 3/8".



For answers to your Monogram, GE Café® Series, GE Profile® Series or GE Appliances product questions, visit our website at geappliances.com or call GE Answer Center® Service, 800.626.2000.



Specification Revised 11/17

GUV27ESSM

GE® Unitized Spacemaker® 3.8 DOE Cu. Ft. Stainless Steel Washer and 5.9 Cu. Ft. Long Vent Electric Dryer

DIMENSIONS AND INSTALLATION INFORMATION (IN INCHES)

For complete information, see installation instructions packed with your dryer.

DUCTING MATERIALS:

For best performance, this dryer should be vented with 4" diameter all rigid metal exhaust duct. If rigid metal duct cannot be used, then UL-listed flexible metal (semi-rigid) ducting can be used (Kit WX08X10077). In special installations, it may be necessary to connect the dryer to the house vent using a flexible metal (foil-type) duct. A UL-listed flexible metal (foil-type) duct may be used ONLY in installations where rigid metal or flexible metal (semi-rigid) ducting cannot be used AND where a 4" diameter can be maintained throughout the entire length of the transition duct. Please see installation instruction packed with your dryer for complete instructions when using flexible metal (foil type) ducting.

EXHAUST LENGTH CALCULATION:

- Determine the number of 90° turns needed for your installation. If you exhaust to the side or bottom of dryer, add one turn.
- The maximum length of 4" rigid (aluminum or galvanized) duct which can be tolerated is shown in the table.

For every extra 90° elbow, reduce the allowable vent system length by 10 ft. Two 45° elbows will be treated like one 90° elbow. For the side exhaust installations, add one 90° elbow to the chart. The total vent system length includes all the straight portions and elbows of the system (transition duct included).

Dryers must be exhausted to the outside.

CAUTION: For personal safety do not terminate exhaust into a chimney, under any enclosed house floor (crawl space), or into an attic, since the accumulated lint could create a fire hazard or moisture could cause damage. Never terminate the exhaust into a common duct or plenum with a kitchen exhaust, since the combination of lint and grease could create a fire hazard.

Exhaust ducts should be terminated in a dampered wall cap to prevent back drafts, bird nesting, etc. The wall cap must also be located at least 12" above the ground or any other obstruction with the opening pointed down.



For answers to your Monogram, GE Café® Series, GE Profile® Series or GE Appliances product questions, visit our website at geappliances.com or call GE Answer Center® Service, 800.626.2000.



Specification Revised 11/17

GUV27 DRYER EXHAUST LENGTH

RECOMMENDED MAXIMUM LENGTH

Exhaust Hood Types

Recommended

Use only for short run installations

No. of 90° Elbows	Rigid Metal	
	4" DIA.	2-1/2" DIA.
0	200 Feet	175 Feet
1	185 Feet	165 Feet
2	175 Feet	155 Feet
3	165 Feet	145 Feet
4	155 Feet	135 Feet
5	145 Feet	125 Feet




For answers to your Monogram, GE Café® Series, GE Profile® Series or GE Appliances product questions, visit our website at geappliances.com or call GE Answer Center® Service, 800.626.2000.



Specification Revised 11/17

SAMPLE LABEL


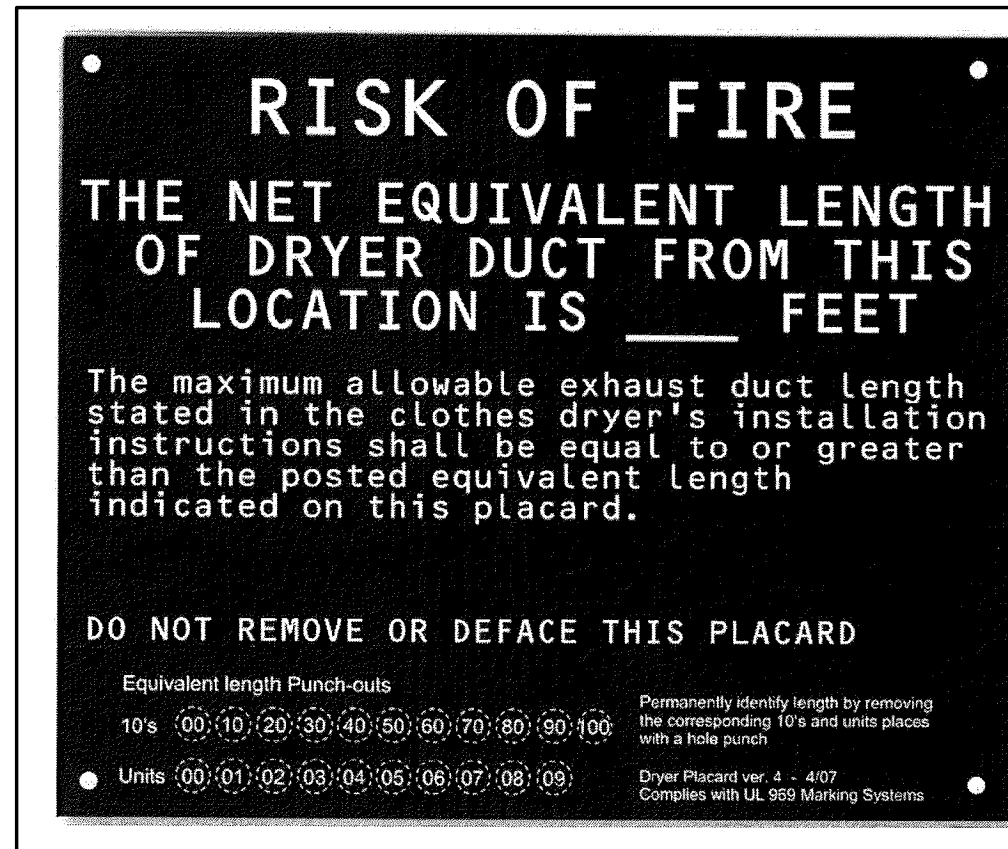


NOTE:

DRYER MAKE AND MODEL SHOWN ARE THE BASIS OF DESIGN FOR DETERMINING MAXIMUM DRYER VENT LENGTHS. IF A DIFFERENT MAKE/MODEL IS USED, NOTIFY THE ENGINEER AND ARCHITECT IMMEDIATELY TO VERIFY VENT LENGTHS AND TO DETERMINE IF DRYER BOOSTER FANS WILL BE NECESSARY.

PER IMC 504.8.5, CONTRACTOR SHALL PROVIDE A LABEL OR PLACARD WITHIN 6 FEET OF THE EXHAUST DUCT CONNECTION THAT LISTS THE EQUIVALENT LENGTH OF THE DRYER EXHAUST DUCT. SEE SAMPLE LABEL FOR DETAILS.

REVISIONS	DESCRIPTION
NO.	DATE

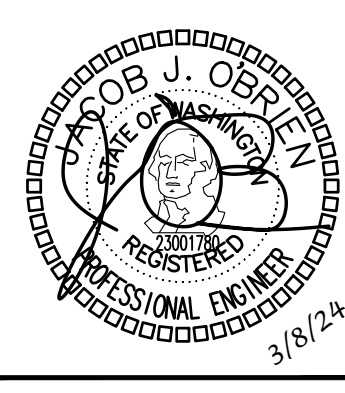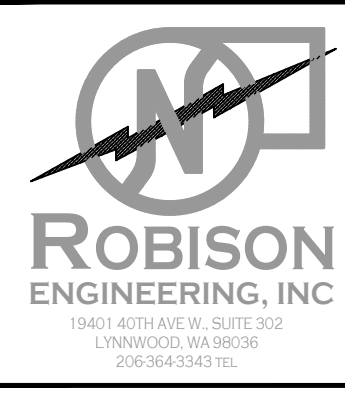


DRAWN:	OP
DESIGNED:	ABE
CHECKED:	PR
APPROVED:	JMR

PROJECT: EAST TOWN CROSSING BUILDING F
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA
19401 ACOTWAYE W. SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 964-3343
RE/PROJECT NO.: 810010
CONTACT: ARK@ESPINELI

DATE:
3/8/2024

SHEET TITLE:
DETAILS & DIAGRAMS

SHEET NO.
M4.0

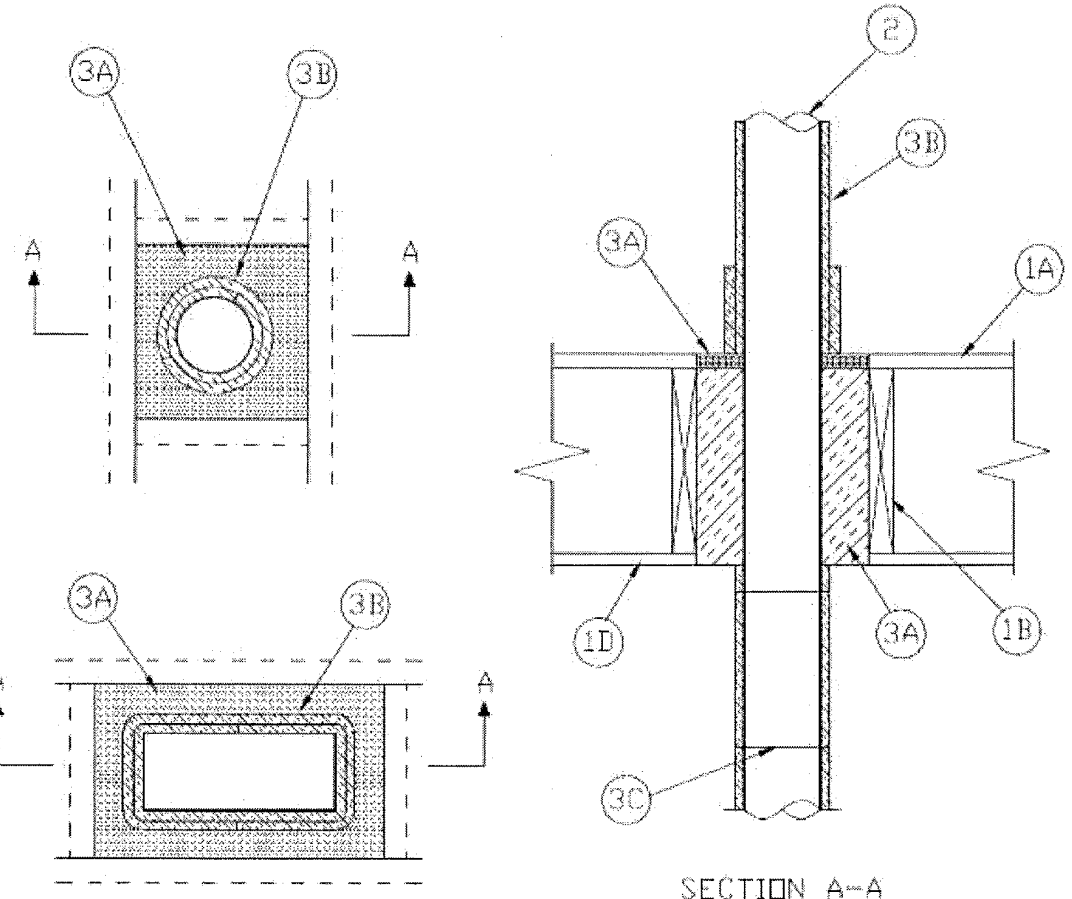

- Floor-Ceiling Assembly** – The 1 hr fire-rated solid or trussed lumber joist floor-ceiling assembly shall be constructed of the materials and in the manner specified in the individual 1500 Series Floor-Ceiling Designs in the UL Fire Resistance Directory. The general construction details of the floor-ceiling assembly are summarized below:
 - Flooring System** – Lumber or plywood subfloor with finish floor of lumber, plywood or **Floor Topping Mixture** as specified in the individual Floor-Ceiling Design. Max area of floor opening is 150 m² (0.098 m²) with a max 1.5 in. (38 mm) annular space between wrapped duct and framing members.
 - Wood Joists** – Nom 10 in. (254 mm) deep (or deeper) lumber, steel or combination lumber and steel joists, trusses or **Structural Wood Members** with bridging as required and with ends firestopped. Additional framing members installed to form a square enclosure around the perimeter of the opening in the floor and ceiling.
 - Furring Channels** – (Where required - not shown) - Resilient galv steel furring installed perpendicular to wood joists between gypsum board and wood joists as specified in the individual Floor-Ceiling Design. Furring channels spaced max 24 in. (610 mm) OC. If furring channels are used within the assembly, additional furring channels to be installed around the periphery of the opening.
 - Gypsum Board** – Nom 4 ft (1.2 m) wide by 5/8 in. (15.9 mm) thick as specified in the individual Floor-Ceiling Design. Gypsum board secured to wood joists or furring channels as specified in the individual Floor-Ceiling Design. Max area of ceiling opening is 150 m² (0.098 m²) with a max 1.5 in. (38 mm) annular space between duct and framing members.
- Steel Air Duct** – Max 7 in. (178 mm) diam by min 0.0157 in. (No. 30 gauge or 0.40 mm) thick galv steel air duct to be centered within the firestop system. Max one steel air duct to be installed within opening. Steel duct to be rigidly supported on top side of floor-ceiling assembly.
 - Steel Air Duct** – Max 10 x 4 in. (254 x 102 mm) rectangular by min 0.022 in. (no. 26 gauge or 0.56 mm) thick galv steel air duct to be centered within the firestop system. Max one steel air duct to be installed within opening. Steel duct to be rigidly supported on top side of floor-ceiling assembly.
- Fire-resistive System** – The fire resistive system shall consist of the following:
 - Firestop System** – When the ventilation duct passes through a fire rated floor assembly, the through openings shall be firestopped in accordance with System No. F-C-7057.
 - Batts and Blankets** – 1/2 in. (13 mm) thick, 8 pcf (128 kg/m³) or nom 1-1/2 in.

(38 mm) thick, 6 pcf (96 kg/m³) with foil-scrim facers. The steel duct shall be wrapped with one layer of duct wrap installed with 1 in. (25 mm) transverse and longitudinal overlaps or tightly butted compression joints in accordance with the manufacturer's installation instructions A min 12 in. high collar consisting of an additional layer of 1/2 in. (13 mm) thick, 8 pcf (128 kg/m³) or nom 1-1/2 in. (38 mm) thick, 6 pcf (96 kg/m³) duct wrap, installed over the duct wrap flush with the top surface of the floor and extending upward. All seams and edges shall be sealed with min 3 in. (76 mm) wide pressure sensitive aluminum foil tape.

UNIFRAX I LLC – FyreWrap® DPS or FyreWrap® Elite 1.5

C. **Steel Tie Wire** – Min No. 18 Gauge (0.040 in. or 1 mm) galvanized steel wire formed into a loop on one end, with the other end passed through the loop, pulled hand tight and bent over. Tie wires spaced a max 12 in. (305 mm) OC.

*Bearing the UL Classification Mark

Last Updated on 2013-10-29

Questions? [Print this page](#) [Terms of Use](#) [Page Top](#)

© 2013 UL LLC

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2013 UL LLC".

UL ONLINE CERTIFICATIONS DIRECTORY

Assembly No. V-32
HNLJ-V-32
Ventilation Duct Assemblies

Page Bottom

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

Ventilation Duct Assemblies

See General Information for Ventilation Duct Assemblies

Assembly No. V-32
October 29, 2013

Duct A	Fire Resistance Rating
	1 Hr

UNIFRAX Product Information Sheet

FyreWrap® DPS Insulation
Dryer Protection System

Introduction
Unifrax's FyreWrap® DPS Insulation is a high-temperature insulation blanket specifically designed. UL tested and certified to provide a single layer, one-hour rated flexible enclosure around dryer and residential kitchen exhaust ductwork.

Dryer Exhaust Applications
FyreWrap DPS is an innovative product that provides a safe and cost-effective means to achieve a one-hour fire resistance rated zero clearance enclosure for routing dryer ductwork, from start to finish, through rated wood truss/joist construction as prescribed by the International Building and Mechanical Codes.

FyreWrap DPS Insulation offers the following product features:

- Lightweight, flexible product form
- Scrim encapsulated
- Easy to cut, fabricate, wrap around ducts, pipes or cables
- Thin, single-layer design
- High-temperature, low bioperisistance fiber

Product Components
Core Material: FyreWrap DPS Insulation incorporates Insulfrax® Thermal Insulation as its core material. Insulfrax is a high-temperature insulation made from a calcia, magnesia, silica chemistry designed to enhance biolubility. It provides excellent insulation in a noncombustible blanket product form.

Typical System Properties

ISO 6944	UL Assembly No. V-32, ULC Assembly No. FRD-29
UL 1479 (ASTM E814), CAN/ULC S115	UL Assembly Nos. F-C-7057, F-C-7058
Intertek Laboratories (CPL) Listed	Applied Fire Protection, File 16341-3
ASTM E 136 Noncombustibility Test	Passes
ASTM E84, UL 723, ULC S102.2	UL File No. R14514
Flame Spread Rating:	Unfaced Blanket: Zero
Smoke Developed Rating:	Encapsulated: <25
	Zero: <50

Encapsulating Material: The core insulation blanket is completely encapsulated in an aluminum foil, fiberglass reinforced scrim covering. This scrim provides additional handling strength as well as protection from moisture absorption and tearing.

Typical Product Parameters

Thickness	1/2"
Density	8pcf
Scrim Encapsulated	
Covering	16" w x 25' L
Product Availability	24" w x 25' L
	26" w x 25' L
	48" w x 25' L

UL Assembly No. V-32, ULC Assembly No. FRD-29
UL Assembly Nos. F-C-7057, F-C-7058
Applied Fire Protection, File 16341-3
Passes
UL File No. R14514
Unfaced Blanket: Zero
Encapsulated: <25
Zero: <50

UL LISTED
Intertek
UL Classified

DATA: Average results of tests conducted under standard procedures and are subject to variation. Results should not be used for specification purposes.

REFER: To the product Safety Data Sheet (SDS) No. M0456 for recommended work practices and other product safety information.

FyreWrap

UL ONLINE CERTIFICATIONS DIRECTORY

UL Product iQ
UL'S NEXT GENERATION CERTIFICATIONS SEARCH
The same trusted data in a modern search engine.

System No. F-C-7057
XHEZ, F-C-7057
Through-penetration Firestop Systems

Page Bottom

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

XHEZ - Through-penetration Firestop Systems

XHEZ7 - Through-penetration Firestop Systems Certified for Canada

See General Information for Through-penetration Firestop Systems

See General Information for Through-penetration Firestop Systems Certified for Canada

System No. F-C-7057
March 27, 2017

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Rating – 1 Hr	F Rating – 1 Hr
T Rating – 1 Hr	FT Rating – 1 Hr
	FH Rating – 1 Hr
	FTH Rating – 1 Hr

FyreWrap® DPS – Dryer Protection System

Figure 1: Max. 7" Dryer Duct, 1-Hour Enclosure

Figure 2: UL Tested 1-Hour Membrane Penetration


Figure 3: UL Tested 1-Hour Dryer Duct System

From C-4055 Effective 6/16 © 2013 Unifrax I LLC All Rights Reserved Printed in USA Page 2 of 2

The following are registered trademarks of Unifrax: FyreWrap, Insulfrax. Product information sheets are periodically updated by Unifrax. Before relying on any data or other information in this Product Information Sheet, you should confirm that it is still current and has not been superseded. A Product Information Sheet that has been superseded may contain incorrect, obsolete and/or irrelevant data and other information.

Unifrax I LLC
Corporate Headquarters
600 Riverwalk Parkway
Suite 120
Bridgewater, NY 14150
Telephone: 716-768-6500
Canada: 1-800-635-4464
Internet: www.unifrax.com
Email: info@unifrax.com

REVISIONS	DESCRIPTION	DATE	NO.

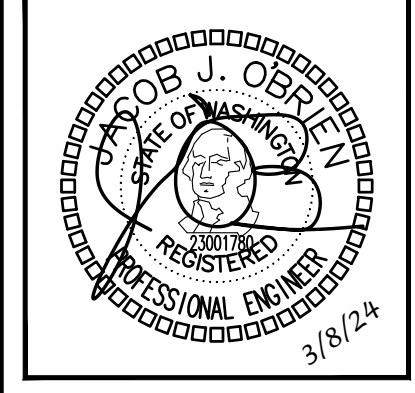

DRAWN:	OP
DESIGNED:	ABE
CHECKED:	PR
APPROVED:	JMR

PROJECT: EAST TOWN CROSSING BUILDING F
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUVALUP, WA

19401 ACHTAVIE W. SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 964-3343
REPROJECT NO.: 810010
CONTACT: ARK@ESPINELI

ROBISON ENGINEERING, INC.

DATE: 3/8/2024

SHEET TITLE: DETAILS & DIAGRAMS

SHEET NO. **M4.1**

DUCT FIRE WRAP
DETAIL
SCALE: NONE

NOTES

DISINFECTION OF POTABLE WATER SYSTEM:

- A. NEW OR REPAIRED POTABLE WATER SYSTEMS SHALL BE DISINFECTED PRIOR TO USE.
- B. INITIAL COLIFORM SAMPLE IS REQUIRED PRIOR TO ADMINISTERING WATER-CHLORINE SOLUTION.
- C. PER UPC SECTION 609.9, BARRING NO ADDITIONAL METHODS PRESCRIBED BY THE LOCAL HEALTH AUTHORITY, DISINFECTION METHOD IS AS FOLLOWS:
 - 1.1. PIPE SYSTEM SHALL BE FLUSHED WITH CLEAN, POTABLE WATER UNTIL POTABLE WATER APPEARS AT THE OUTLET.
 - 1.2. THE SYSTEM OR PARTS THEREOF SHALL BE FILLED WITH A WATER-CHLORINE SOLUTION CONTAINING NOT LESS THAN 50 PPM OF CHLORINE, AND THE SYSTEM OR PART THEREOF SHALL BE VALVED-OFF AND ALLOWED TO STAND FOR 24 HOURS; OR, THE SYSTEM OR PART THEREOF SHALL BE FILLED WITH A WATER-CHLORINE SOLUTION CONTAINING NOT LESS THAN 200 PPM OF CHLORINE AND ALLOWED TO STAND FOR 3 HOURS.
 - 1.3. FOLLOWING THE ALLOWED STANDING TIME, THE SYSTEM SHALL BE FLUSHED WITH CLEAN, POTABLE WATER UNTIL THE CHLORINE RESIDUAL IN THE WATER COMING FROM THE SYSTEM DOES NOT EXCEED THE CHLORINE RESIDUAL IN THE FLUSHING WATER.
 - 1.4. THE PROCEDURE SHALL BE REPEATED WHEN A STANDARD BACTERIOLOGICAL TEST FOR DRINKING WATER, PERFORMED BY A LABORATORY CERTIFIED FOR DRINKING WATER IN WASHINGTON STATE, SHOWS UNSATISFACTORY RESULTS INDICATING THAT CONTAMINATION PERSISTS IN THE SYSTEM.
 - 1.5. NOTE: TEST FILL PORT TO ADD CHLORINE MUST BE WHERE WATER SUPPLY ENTERS BUILDING AND A FLOW METER TO MEASURE SOLUTION.
- D. AFTER WATER-CHLORINE SOLUTION IS INCORPORATED INTO THE NEW OR REPAIRED WATER SYSTEM, A 48 HOUR WAITING PERIOD MUST BE OBSERVED PRIOR TO BACTERIOLOGICAL TEST.
- E. BACTERIOLOGICAL TEST SHALL BE CONDUCTED BY A LABORATORY CERTIFIED FOR DRINKING WATER IN WASHINGTON STATE AFFIRMING WATER QUALITY CONTAINS NO COLIFORM BY SAMPLE TESTING THE FURTHEST FIXTURE FROM PUBLIC WATER COURSE AND NOT LESS THAN TWO OTHER LOCATIONS PART OF THE WATER SUPPLY SYSTEM.
- F. CHLORINE LEVEL IN THE NEW OR REPAIRED WATER SUPPLY SYSTEM SHALL NOT BE LESS THAN THE MEAN AVERAGE OF THE AREA IN RELATIONSHIP FROM THE WATER PURVEYOR SOURCE.

CALCULATIONS

TYPE L COPPER SERVICE PIPING

ROBISON ENGINEERING, INC.		PROJ. NAME: EAST TOWN CROSSING					
		PROJ. NO.: 810-010					
		BY: JMN					
WASTE CALCULATIONS							
RESIDENTIAL UNITS							
FIXTURE TYPE	F.U. EACH	FLOOR LEVEL			TOTAL QTY OF FIXTURES	TOTAL FIXTURE UNITS	
		1	2	3			
LAVATORY	1	14	16	16	46	46	
WATER CLOSET	3	14	14	14	42	126	
CLOTHES WASHER	3	8	8	8	24	72	
HUB DRAIN	4	8	8	8	24	96	
FLOOR SINK (4" DRAIN)	8	1	0	0	1	8	
FLOOR DRAIN (2" DRAIN)	2	1	0	0	1	2	
BATH TUB	2	10	10	10	30	60	
KITCHEN SINK WITH DISHWASHER	2	8	8	8	24	48	
TOTAL					458		
TOTAL FIXTURE UNITS:		458				FIXTURE UNIT VALUES PER UPC TABLE 702.1	



ROBISON ENGINEERING, INC.		PROJ. NAME: EAST TOWN CROSSING					
		PROJ. NO.: 810-010					
		BY: JMN					
COLD WATER CALCULATIONS							
RESIDENTIAL UNITS							
FIXTURE TYPE	F.U. EACH	FLOOR LEVEL			TOTAL QTY OF FIXTURES	TOTAL FIXTURE UNITS	
		1	2	3			
LAVATORY	1	14	16	16	46	46	
WATER CLOSET	2.5	14	14	14	42	105	
CLOTHES WASHER	4	8	8	8	24	96	
BATH TUB	4	10	10	10	30	120	
KITCHEN SINK WITH DISHWASHER	1.5	8	8	8	24	36	
TOTAL					403		
TOTAL FIXTURE UNITS:		403				FIXTURE UNIT VALUES PER UPC TABLE 810.3	

Robison Engineering, Inc. 19401 40th Ave W, Suite 302 Lynnwood, WA 98036		Project Name: EAST TOWN CROSSING Project Number: 810-010 Edited By: JDM/JMN Edit Date: 1/22/2024							
SIZING IS PER 2015 UPC APPENDIX A									
WATER SUPPLY PIPE SIZING CALCULATION FORM									
UTILITY SUPPLY WATER PRESSURE:	55	PSI	STATIC PRESSURE						
<i>ASSUMING BUILDING PRESSURE</i>									
BOOSTER PUMP:	70	PSI							
OUTLET PRESSURE									
WATER SOFTENER LOSS:	0	PSI							
<i>TYPICALLY 5-20 PSI, IF NO SOFTENER ENTER "0"</i>									
STATIC LIFT:	30	FEET =	13.0 PSI						
OTHER LOSS:	0	PSI							
OTHER LOSS:	0	PSI							
REQUIRED MINIMUM PRESSURE AT FURTHEST PLUMBING FIXTURE:	25	PSI							
PRESSURE AVAILABLE TO OFFSET FRICTION LOSSES:	32.0	PSI							
PIPING SYSTEM LENGTH FROM SERVICE TO FURTHEST FIXTURE:	200	FEET							
FITTING ALLOWANCE:	66.667	FEET							
MAXIMUM FRICTION LOSS FACTOR:	12.0	PSI/100 FT							
SELECTED FRICTION LOSS FACTOR:	12.0	PSI/100 FT							
<i>MAX CW VELOCITY 8 FPS, MAX HW VELOCITY 5 FPS</i>									
SUPPLY PIPE SIZING SCHEDULE									
FLUSH TANK CW		HOT WATER		Copper Type: Type L		FLUSH VALVE CW			
PIPE SIZE	FLOW, GPM	VEL, FPS	FIXTURE UNITS	FLOW, GPM	VEL, FPS	FIXTURE UNITS	FLOW, GPM	VEL, FPS	FIXTURE UNITS
2-1/2"	116.0	8.0	440.0	72.0	5.0	215.0	116.0	8.0	340.0
3"	160.0	8.0	750.0	100.0	5.0	350.0	160.0	8.0	680.0
4"	280.0	8.0	1600.0	175.0	5.0	800.0	280.0	8.0	1600.0
6"	650.0	8.0	5250.0	400.0	5.0	2750.0	650.0	8.0	5250.0

PEX PIPING

Robison Engineering, Inc. 19401 40th Ave W, Suite 302 Lynnwood, WA 98036		Project Name: East Town Crossing Project Number: 810-010 Edited By: JDM/JMN Edit Date: 1/22/24		
SIZING IS PER 2015 UPC APPENDIX A				
WATER SUPPLY PIPE SIZING CALCULATION FORM				
AVAILABLE PRESSURE BEFORE BOOSTER PUMP:	55	PSI		
AVAILABLE PRESSURE AFTER BOOSTER PUMP:	70	PSI		
STATIC LIFT TO HIGHEST FIXTURE:	30	FEET =	13.0 PSI	
REQUIRED MINIMUM PRESSURE AT FURTHEST PLUMBING FIXTURE:	25	PSI		
PRESSURE AVAILABLE TO OFFSET FRICTION LOSSES:	32.0	PSI		
PIPING SYSTEM LENGTH FROM SERVICE TO FURTHEST FIXTURE:	200	FEET		
FITTING ALLOWANCE:	66	FEET		
MAXIMUM FRICTION LOSS FACTOR:	12.0	PSI/100 FT		
SELECTED FRICTION LOSS FACTOR:	12.0	PSI/100 FT		
<i>MAX HW & CW VELOCITY 8 FPS</i>				
SUPPLY PIPE SIZING SCHEDULE				
PIPE SIZE	FLOW, GPM	VELOCITY FPS	FIXTURE UNITS	PIPE MATERIAL
1/2"	3.5	8.00	3.0	PEX
3/4"	7.9	8.00	9.0	PEX
1"	14.6	8.00	20.0	PEX
1-1/4"	27.8	8.00	33.0	PEX
1-1/2"	30.3	8.00	54.0	PEX
2"	52.0	8.00	134.0	PEX
2-1/2"	79.2	8.00	270.0	PEX
3"	112.6	8.00	440.0	PEX

REVISIONS	DESCRIPTION	DATE	NO.

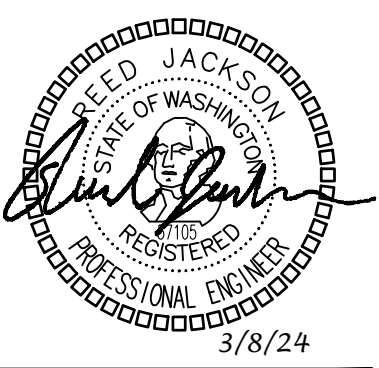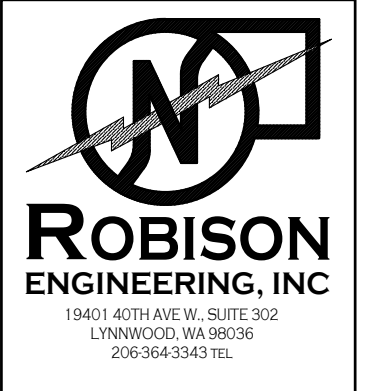

DRAWN:	JMN
DESIGNED:	JMN
CHECKED:	JMN
APPROVED:	JMN

PROJECT: EAST TOWN CROSSING - BUILDING F
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-864-3343

DATE:
3-8-2024

SHEET TITLE:
CALCULATIONS

SHEET NO.
P001

SCHEDULES

PIPE INSULATION SCHEDULE

SERVICE	MATERIAL	PIPE INSULATION					VAPOR RETARDER REQUIRED	NOTES
		NOMINAL PIPE SIZE (IN.)	1/2 - 1	1-1/4	1-1/2	2 AND LARGER		
DOMESTIC HOT WATER AND RECIRCULATED HOT WATER	MINERAL-FIBER WITH JACKET	INSULATION THICKNESS (IN.)	1	1-1/4	1-1/2	2	NO	(1)(2)(3)(4)(5)
EXPOSED SANITARY DRAINS AND DOMESTIC WATER SUPPLIES AND STOPS FOR ADA FIXTURES	TRUEBRO LAV-GUARD	N/A					NO	P-TRAP AND SUPPLY COVERS

NOTES: (1) FOR APPLICABLE CODES, REFER TO DWG P000.

- PIPING INSULATION EXPOSED TO WEATHER SHALL BE PROTECTED FROM DAMAGE. CONTRACTOR SHALL PROVIDE SHIELDING FROM SOLAR RADIATION THAT CAN CAUSE DEGRADATION OF THE MATERIAL. ADHESIVE TAPE SHALL NOT BE PERMITTED.
- HOT WATER AND HOT WATER CIRCULATION PIPING SHALL BE INSULATED PER 2015 UPC AND 2015 WSEC.
- PER 2015 UPC SECTION 312.6, NO WATER, SOIL OR WASTE PIPE SHALL BE INSTALLED OR PERMITTED OUTSIDE OF THE BUILDING, IN THE ATTIC, OR IN AN EXTERIOR WALL UNLESS ADEQUATE PROVISION IS MADE TO PROTECT SUCH PIPE FROM FREEZING. ALL HOT AND COLD WATER PIPES OUTSIDE THE CONDITIONED SPACE SHALL BE INSULATED TO A MINIMUM OF R-3.
- HEAT TRACING SHALL BE PROVIDED FOR COLD WATER AND IRRIGATION WATER IN UNCONDITIONED SPACES. HEAT TRACING OF OUTDOOR PIPING SHALL INCLUDE AUTOMATIC CONTROLS CONFIGURED TO SHUT OFF THE SYSTEM WHEN OUTDOOR AIR TEMPERATURES ARE ABOVE 40°F.

PIPE MATERIALS SCHEDULE

SERVICE	MATERIAL	JOINT	NOTES
WATER SERVICE ENTRANCE PIPING 3" & LARGER	COPPER TYPE L	SOLDER	(1)(2)(3)
WATER DISTRIBUTION PIPING, 3" & SMALLER	PEX	COLD EXPANSION FITTINGS	(1)(2)(3)
WATER DISTRIBUTION PIPING WITHIN RESIDENTIAL UNITS	PEX	COLD EXPANSION FITTINGS	(1)(2)
SANITARY SEWER & VENT PIPING, BELOW GRADE	PVC SCH 40	SOLVENT CEMENT	(1)(2)(3)(5)(6)(9)
SANITARY SEWER & VENT PIPING, ABOVE GRADE	ABS SCH 40	SOLVENT CEMENT	(1)(2)(4)(5)(6)(7)(8)
STORM DRAIN PIPING, BELOW GRADE	PVC SCH 40	SOLVENT CEMENT	(1)(2)(3)(9)
STORM DRAIN PIPING, ABOVE GRADE	ABS SCH 40	SOLVENT CEMENT	(1)(2)(4)(7)(8)
CONDENSATE DRAIN PIPING	CPVC SCH 40	SOLVENT CEMENT	(1)(2)

- NOTES: (1) PIPE MATERIALS SHALL BE LISTED BY AN APPROVED LISTING AGENCY AND COMPLY WITH UPC SECTION 407.2 AS AMENDED BY THE STATE OF WASHINGTON. (2) CONTRACTOR SHALL INDICATE THE TYPE OF PIPE MATERIALS INCLUDED IN THEIR BID. ALTERNATE PIPE MATERIALS SHALL BE SUBMITTED TO THE OWNER AND THE ENGINEER FOR APPROVAL PRIOR TO INSTALLATION. (3) PLASTIC WRAP UNDERGROUND SUPPLY PIPING TO PREVENT CORROSION. (4) HORIZONTAL OFFSETS IN DWELLING UNIT CEILINGS OR NOISE-SENSITIVE AREAS SHALL BE CAST IRON OR ACOUSTICALLY INSULATED. (5) PROVIDE THERMAL EXPANSION COMPENSATION FOR ALL PLASTIC PIPING PER MANUFACTURER REQUIREMENTS. (6) PVC PIPING SHALL NOT BE USED FOR RECEPTOR AND TRAP ARM WHERE WASTE TEMPERATURE CAN EXCEED 110°F. THIS INCLUDES PIPING AND RECEPTORS FOR 3 COMPARTMENT SINK, COMMERCIAL DISHWASHER, COMMERCIAL LAUNDRY SINK, AND CONDENSATE DRAIN FOR GAS FIRED EQUIPMENT. (7) TRAP ARM FOR WASTE RECEPTOR OF SODA DISPENSERS SHALL BE PVC. CAST IRON PIPING IS PROHIBITED FOR HIGH ACIDITY DRAINS (PH<3). (8) ABS/PVC SHALL NOT BE USED IN PLENUM SPACES. PROVIDE SLIDE FITTINGS ON VERTICAL ABS/PVC RISERS EVERY TWO FLOORS, OR PROVIDE SUFFICIENT OFFSETS TO ACCOMMODATE THERMAL EXPANSION. (9) PER UPC SECTION 605.12.2 AND 705.5.2, PVC PIPING REQUIRES THE USE OF PURPLE PRIMER AND SOLVENT CEMENT.

PLUMBING FIXTURE FLOW RATES PER UPC CH. 4

FIXTURE TYPE	FLOW RATE	NOTES
SHOWERHEADS	2.5 GPM @ 80 PSI	
LAVATORY FAUCETS, RESIDENTIAL	2.2 GPM @ 60 PSI	1
LAVATORY FAUCETS, NON-RESIDENTIAL	0.5 GPM @ 60 PSI	2
KITCHEN FAUCETS	2.2 GPM @ 60 PSI	3
GRAVITY TANK-TYPE WATER CLOSETS	1.6 GALLONS/FLUSH	4
FLUSHOMETER TANK WATER CLOSETS	1.6 GALLONS/FLUSH	4
FLUSHOMETER VALVE WATER CLOSETS	1.6 GALLONS/FLUSH	4
ELECTROMECHANICAL HYDRAULIC WATER CLOSETS	1.6 GALLONS/FLUSH	4
URINALS	1.0 GALLONS/FLUSH	

NOTES:

- LAVATORY FAUCETS SHALL NOT HAVE A FLOW RATE LESS THAN 0.8 GPM AT 20 PSI.
- WHERE COMPLYING FAUCETS ARE UNAVAILABLE, AERATORS RATED AT 0.35 GPM OR OTHER MEANS MAY BE USED TO ACHIEVE REDUCTION.
- KITCHEN FAUCETS MAY TEMPORARILY INCREASE FLOW ABOVE THE MAXIMUM RATE, BUT NOT ABOVE 2.2 GPM @ 60 PSI AND MUST DEFAULT TO A MAXIMUM FLOW RATE OF 1.8 GPM @ 60 PSI.
- INCLUDES SINGLE AND DUAL FLUSH WATER CLOSETS WITH AN EFFECTIVE FLUSH OF 1.6 GALLONS OR LESS. SINGLE FLUSH TOILETS - THE EFFECTIVE FLUSH VOLUME SHALL NOT EXCEED 1.6 GALLONS. THE EFFECTIVE FLUSH VOLUME IS THE AVERAGE FLUSH VOLUME WHEN TESTED IN ACCORDANCE WITH ASME A112.19.2 DUAL FLUSH TOILETS - THE EFFECTIVE FLUSH VOLUME SHALL NOT EXCEED 1.6 GALLONS. THE EFFECTIVE FLUSH VOLUME IS DEFINED AS THE COMPOSITE, AVERAGE FLUSH VOLUME OF TWO REDUCED FLUSHES AND ONE FULL FLUSH. FLUSH VOLUMES WILL BE TESTED IN ACCORDANCE WITH ASME A112.19.2 AND ASME A112.19.14.

PIPING SUPPORTS (SUPPLY)

ALL SUSPENDED WATER SUPPLY PIPE SHALL BE SUPPORTED AS FOLLOWS PER UPC:

	MAX. HORIZONTAL SPACING	MAX. VERTICAL SPACING
COPPER PIPE >2"	10 FT.	10 FT.
PEX ≤ 1"	32 IN.	10 FT.
PEX > 1 1/2"	4 FT.	10 FT.

PIPING SUPPORTS (WASTE)

ALL SUSPENDED SANITARY AND VENT PIPE SHALL BE SUPPORTED AS FOLLOWS PER UPC:

	MAX. HORIZ. SPACING	MAX. VERT. SPACING
ABS	4 FT.	10 FT.
PVC (TYPE DWV)	4 FT.	10 FT.
CAST-IRON (<10 FT PIPE SECTIONS)	5 FT.	15 FT.
CAST-IRON (10 FT PIPE SECTIONS)	10 FT.	15 FT.

NOTE: CAST-IRON PIPES WITH COMPRESSION GASKETS ARE TO BE HUNG AT EVERY OTHER JOINT UNLESS OVER 4 FEET, THEN HUNG AT EACH JOINT.

PLUMBING FIXTURE SCHEDULE (NOTE 1)

EQUIP NO.	FIXTURE TYPE	SERVICE SIZE (INCHES)				MANUFACTURER	MODEL	FINISH	COMMENTS
		CW	HW	W	V				
WC-1	WATER CLOSET	1/2	-	3	2			WHITE	ROUND TOILET
								WHITE	ROUND TOILET SEAT WITH COVER
WC-2	WATER CLOSET (ADA)	1/2	-	3	2			WHITE	ELONGATED TOILET
								WHITE	ELONGATED TOILET SEAT WITH COVER
LAV-1	LAVATORY	1/2	1/2	2	1-1/2			WHITE	
								CHROME	
LAV-2	LAVATORY (ADA)	1/2	1/2	2	1-1/2			WHITE	
								CHROME	
BATH-1	BATH/SHOWER	3/4	3/4	2	1-1/2			WHITE	
								CHROME	
								N/A	
								N/A	
BATH-2	BATH/SHOWER (ADA)	3/4	3/4	2	1-1/2			WHITE	
								CHROME	
								N/A	
								N/A	
SK-1	KITCHEN SINK	1/2	1/2	2	1-1/2			STAINLESS STEEL	
	(SINGLE BOWL)							CHROME	
SK-2	KITCHEN SINK (ADA)	1/2	1/2	2	1-1/2			STAINLESS STEEL	
	(SINGLE BOWL)							CHROME	
SK-3	KITCHEN SINK	1/2	1/2	2	1-1/2			STAINLESS STEEL	
	(DOUBLE BOWL)							CHROME	
SK-4	KITCHEN SINK (ADA)	1/2	1/2	2	1-1/2			STAINLESS STEEL	
	(DOUBLE BOWL)							CHROME	
WB-1	CLOTHES WASHER BOX	3/4	3/4	2	1-1/2			WHITE	UL LISTED FOR RATED ASSEMBLIES
HD-1	HUB DRAIN	-	-	2	1-1/2				PROVIDE 2x4 REDUCER
FS-1	FLOOR SINK	-	-	(NOTE 2)		PROFLO	PF906	WHITE	OR JOSAM, WADE, JAY R. SMITH
FD-1	FLOOR DRAIN	-	-	(NOTE 2)		ZURN	FD-2220	NICKEL	OR JOSAM, WADE, JAY R. SMITH
WCO	WALL CLEANOUT	-	-	-	-		ZURN	Z-1441	N/A
FCO	FLOOR CLEANOUT	-	-	-	-		ZURN	Z-1440	N/A

- NOTES: (1) CONTRACTOR SHALL CONFIRM MAKE, MODEL, AND FINISH WITH OWNER PRIOR TO ORDERING. (2) SIZE PER PLANS.

PACKAGED BOOSTER PUMP SCHEDULE

EQUIP NO.	SERVICE	TYPE	TOTAL FLOW, GPM	PRESSURE RISE INLET/OUTLET PSIG	MOTOR HP (EACH)	STORAGE TANK TYPE	ELECTRICAL	FLA (AMPS)	WEIGHT, LBS	BASIS OF DESIGN (1)(2)(3)
BP-1	DOMESTIC WATER	DUPLEX	103	30 (40/70)	2	INTEGRAL	208V/3P	13.3	730	FLOWTHERM FMV2-3LH

- NOTES: (1) SINGLE POINT POWER CONNECTION. (2) PROVIDE ALL REQUIRED VALVES, PIPING, CONTROLS, ETC. FOR A COMPLETE SYSTEM. (3) PROVIDE VFD'S FOR EACH PUMP.

HYBRID WATER HEATER SCHEDULE

EQUIP NO.	SERVICE	STORAGE GALLONS	STORAGE TEMP °F	ELECTRICAL		UNIFORM ENERGY FACTOR	BASIS OF DESIGN (1)(2)
				VOLTAGE	MOCF		
HPWH-1	PER PLANS	50	120	208V/1P	30	3.80	A.O.SMITH HPTS-50

- NOTES: (1) INSTALL IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION REQUIREMENTS. (2) PER WSEC R406, ENERGY CREDIT OPTION 5.5, HEAT PUMP WATER HEATER MUST THE STANDARDS FOR TIER III OF NEEA'S ADVANCED WATER HEATER SPECIFICATION.

EXPANSION TANK SCHEDULE



EQUIP NO.	SERVICE	CAPACITY .GAL	TANK SIZE		BASIS OF DESIGN
			DIA	HEIGHT	
ET-1	WH-1	2	8	13	AMTROL ST-5

REDUCED PRESSURE ZONE ASSEMBLY SCHEDULE

EQUIP NO.	SERVICE	INLET/OUTLET SIZE (INCHES)	DESIGN FLOW RATE, GPM	PRESSURE DROP AT DESIGN FLOW RATE, PSI	MAXIMUM WORKING PRESSURE, PSI	BASIS OF DESIGN (1)(2)
RPBA-1	DOMESTIC WATER SERVICE	3"	103	15	175	ZURN 3750SY

- NOTES: (1) INSTALL IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION REQUIREMENTS. (2) BACKFLOW DEVICE SHALL COMPLY WITH AWWA C-511-92 STANDARDS.

REVISIONS	DATE	DESCRIPTION
NO.		

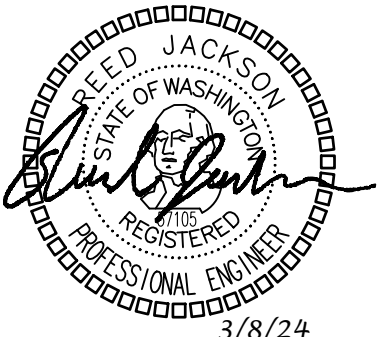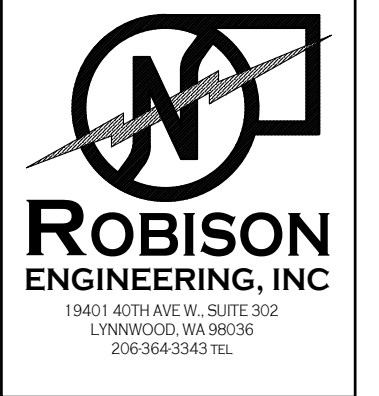

JMN	JMN	JMN	JMN
DRAWN:	DESIGNED:	CHECKED:	APPROVED:

PROJECT: EAST TOWN CROSSING - BUILDING F
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206.864.3343




DATE:
3-8-2024

SHEET TITLE:
SCHEDULES

SHEET NO.

P002

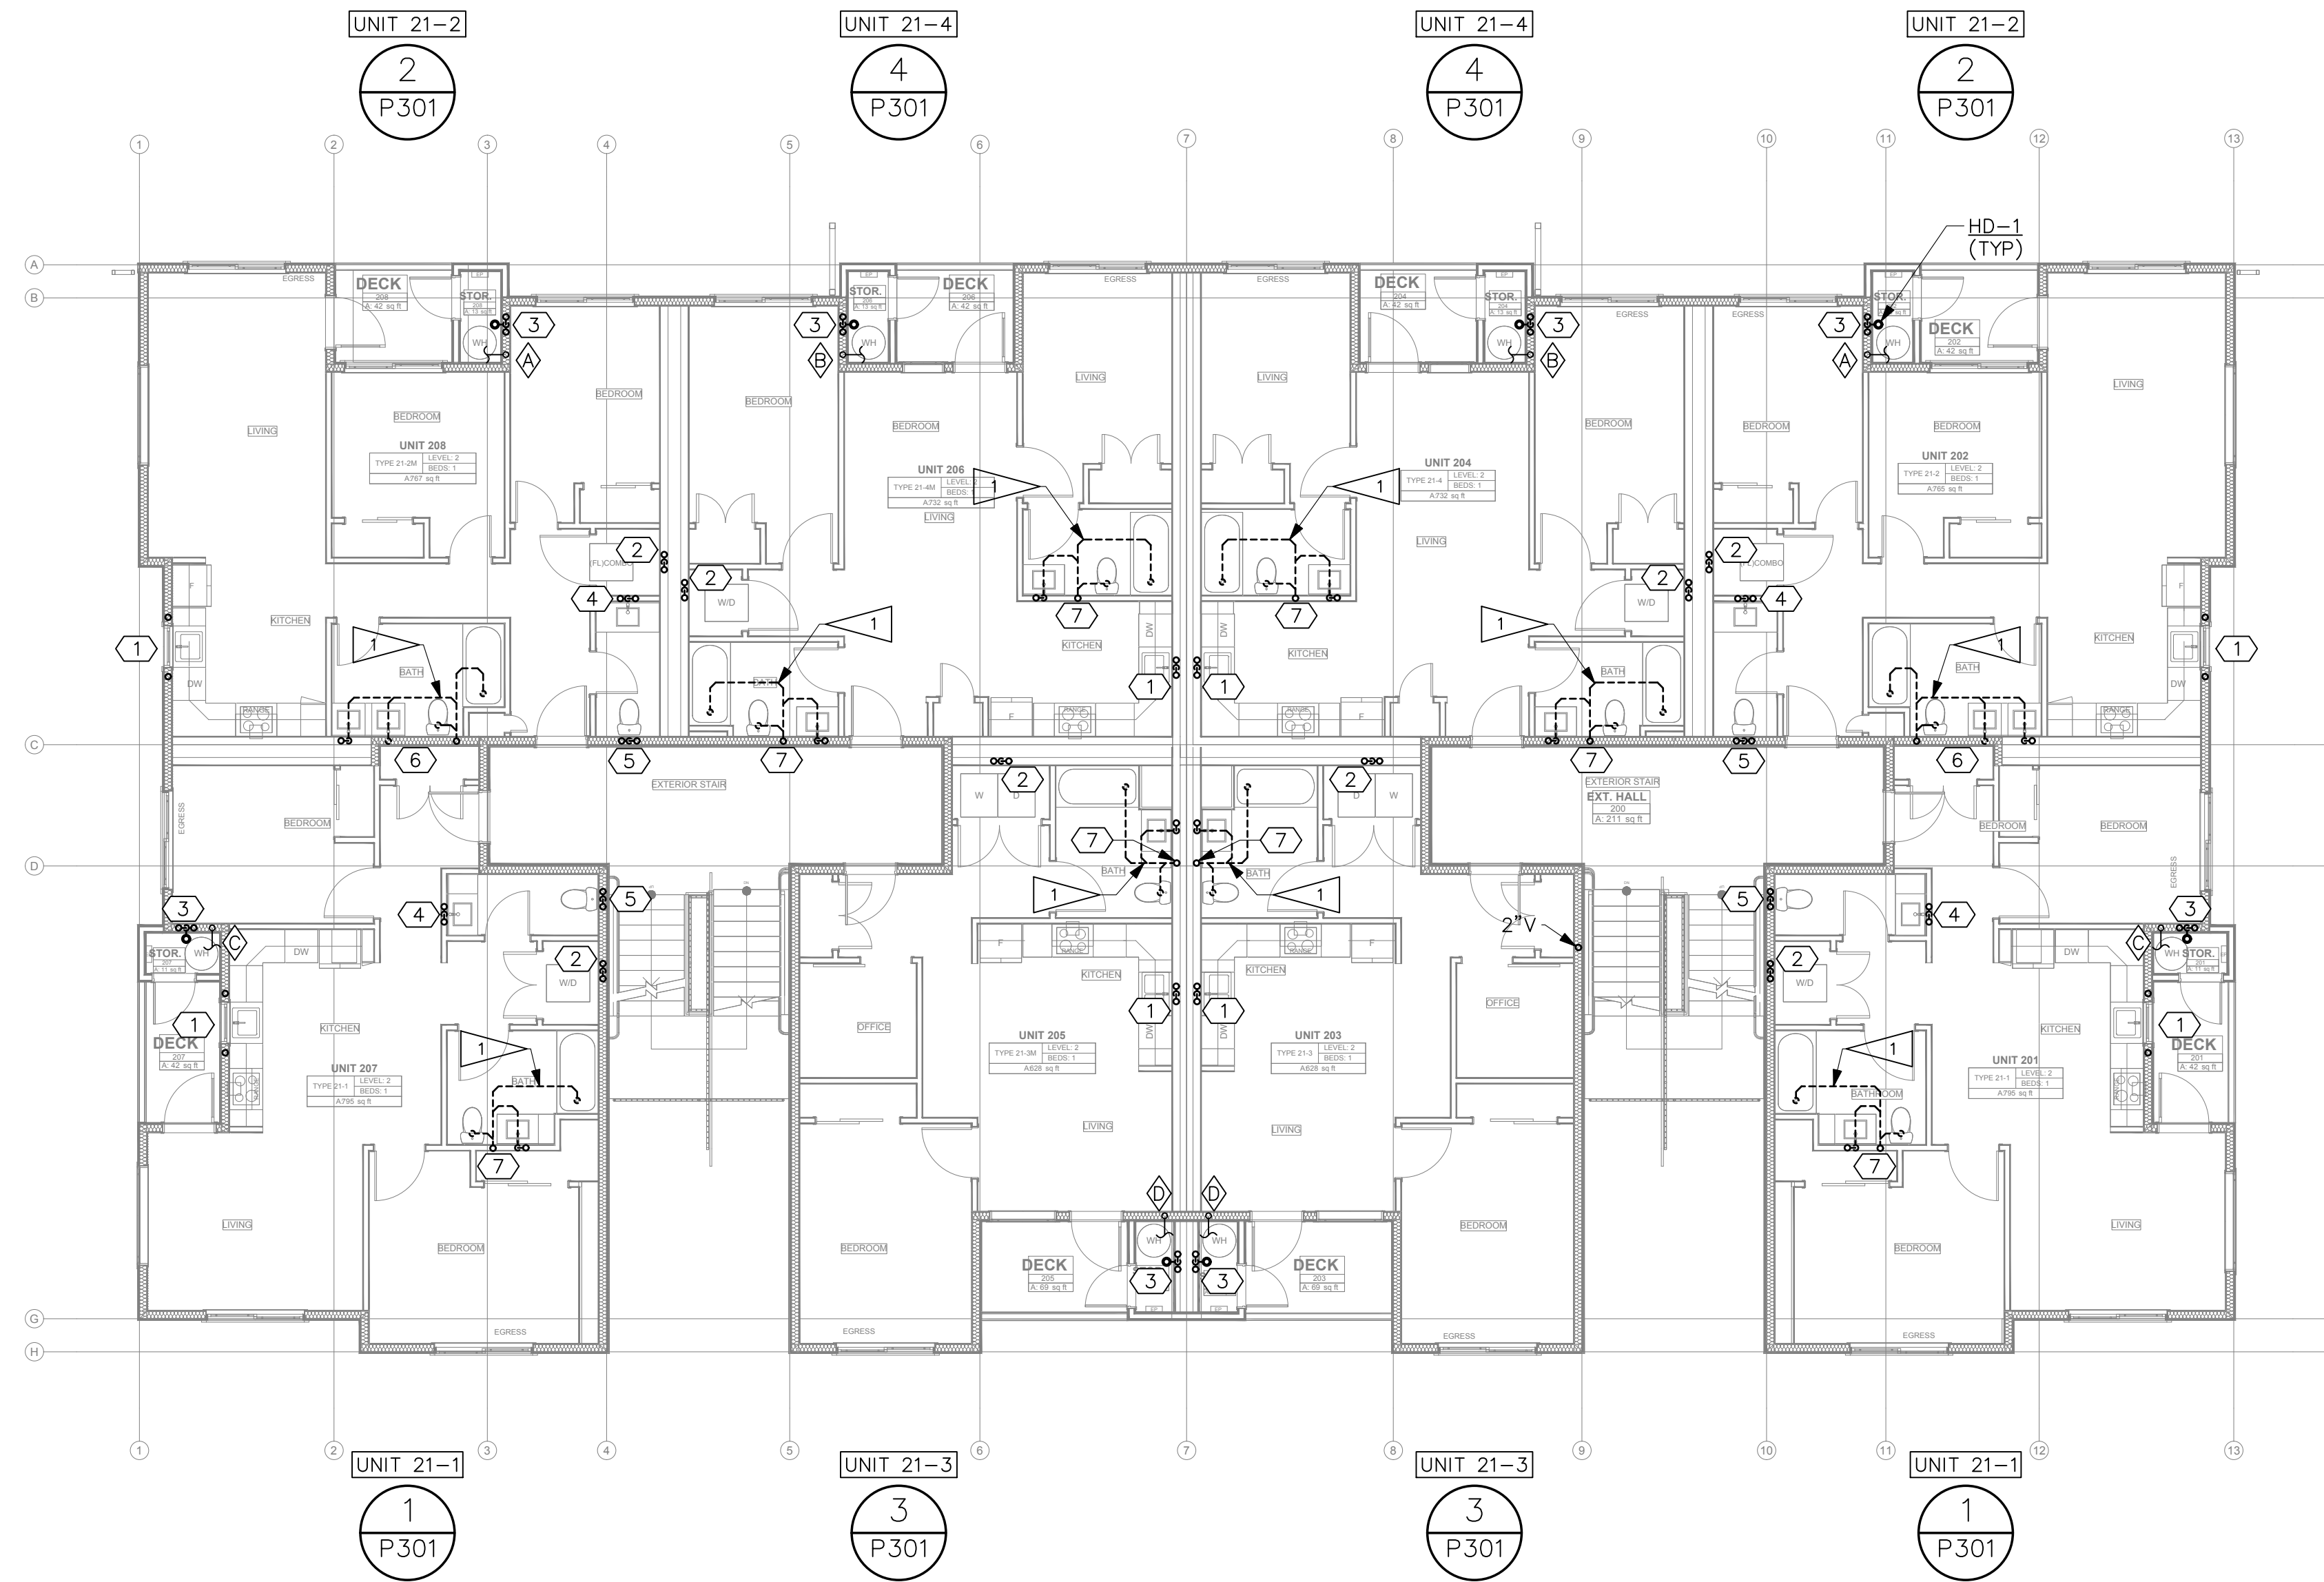

RESIDENTIAL UNIT NOTES:

UNIT A = UNIT TYPE A (FOR EXAMPLE)
REFER TO DWG M300, DETAIL 1.

FOR PIPING WITHIN THE RESIDENTIAL UNITS, REFER TO THE UNIT PLANS ON DWGS P300 & P301.

⊠ = WATER SUPPLY RISER IDENTIFICATION (RISER "B", FOR EXAMPLE). REFER TO DWG P401, DETAIL 1 FOR RISER DETAILS/PIPE SIZES.

⊡ = WASTE/VENT RISER IDENTIFICATION (RISER "5", FOR EXAMPLE). REFER TO DWG P400, DETAIL 1 FOR RISER DETAILS/PIPE SIZES.



WASTE PIPING SIZING:

HORIZONTAL WASTE PIPING SHALL BE SLOPED AT 1/4" PER LINEAR FOOT. PROVIDE CLEANOUTS PER CURRENT UPC AND AS REQUIRED BY LOCAL JURISDICTIONS. CLEANOUTS SHALL BE LOCATED IN WALLS/FLOORS WHERE THEY ARE NOT HIGHLY VISIBLE. FLOOR CLEANOUTS IN CARPETED AREAS SHALL BE FITTED WITH CARPET INSERTS. LOCATIONS SHALL BE SUBMITTED TO THE ARCHITECT FOR APPROVAL. NOTE: NOT ALL CLEANOUTS ARE SHOWN ON THE PLUMBING PLANS.

FLAG NOTES:

1 WASTE PIPING ROUTED IN CEILING OF FLOOR BELOW.

NO.	DATE	DESCRIPTION

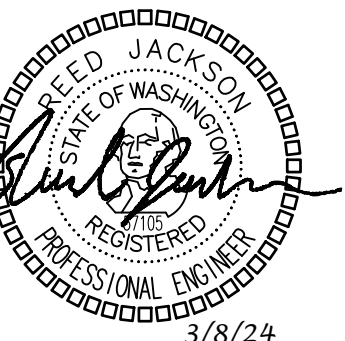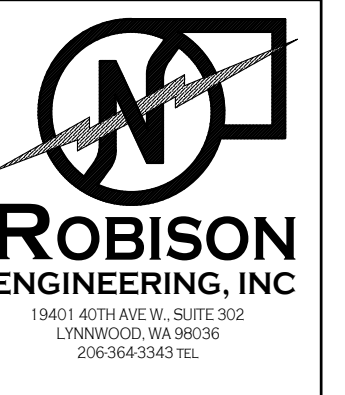

DRAWN:	JMN
DESIGNED:	JMN
CHECKED:	JMN
APPROVED:	JMN

PROJECT: **EAST TOWN CROSSING - BUILDING F**
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-864-3343

ROBISON ENGINEERING, INC.

DATE:
3-8-2024

SHEET TITLE:
BUILDING F -
LEVEL 2 FLOOR
PLAN

SHEET NO.
P202

BUILDING F
 LEVEL 2 FLOOR PLAN
 SCALE: 1/8" = 1'-0"





TABLE 814.3	
MINIMUM CONDENSATE PIPE SIZE	
EQUIPMENT CAPACITY IN TONS OF REFRIGERATION	MINIMUM CONDENSATE PIPE DIAMETER (INCHES)
UP TO 20	3/4
21 - 40	1
41 - 90	1-1/4
91 - 125	1-1/2
126 - 250	2

NOTE: CONDENSATE PIPING SHALL NOT BE SMALLER THAN THE EQUIPMENT CONNECTION PER THE MANUFACTURER'S INSTALLATION REQUIREMENTS.

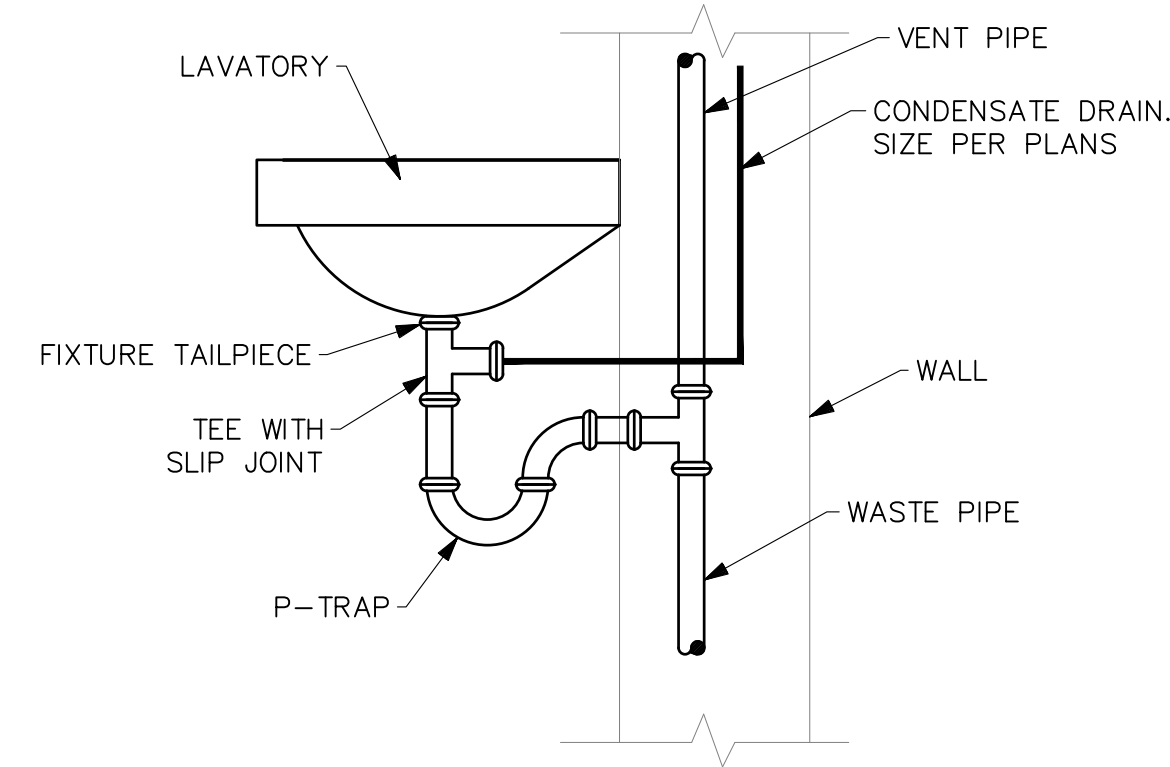


CONDENSATE TERMINATION

DETAIL

SCALE: NONE

4
P402

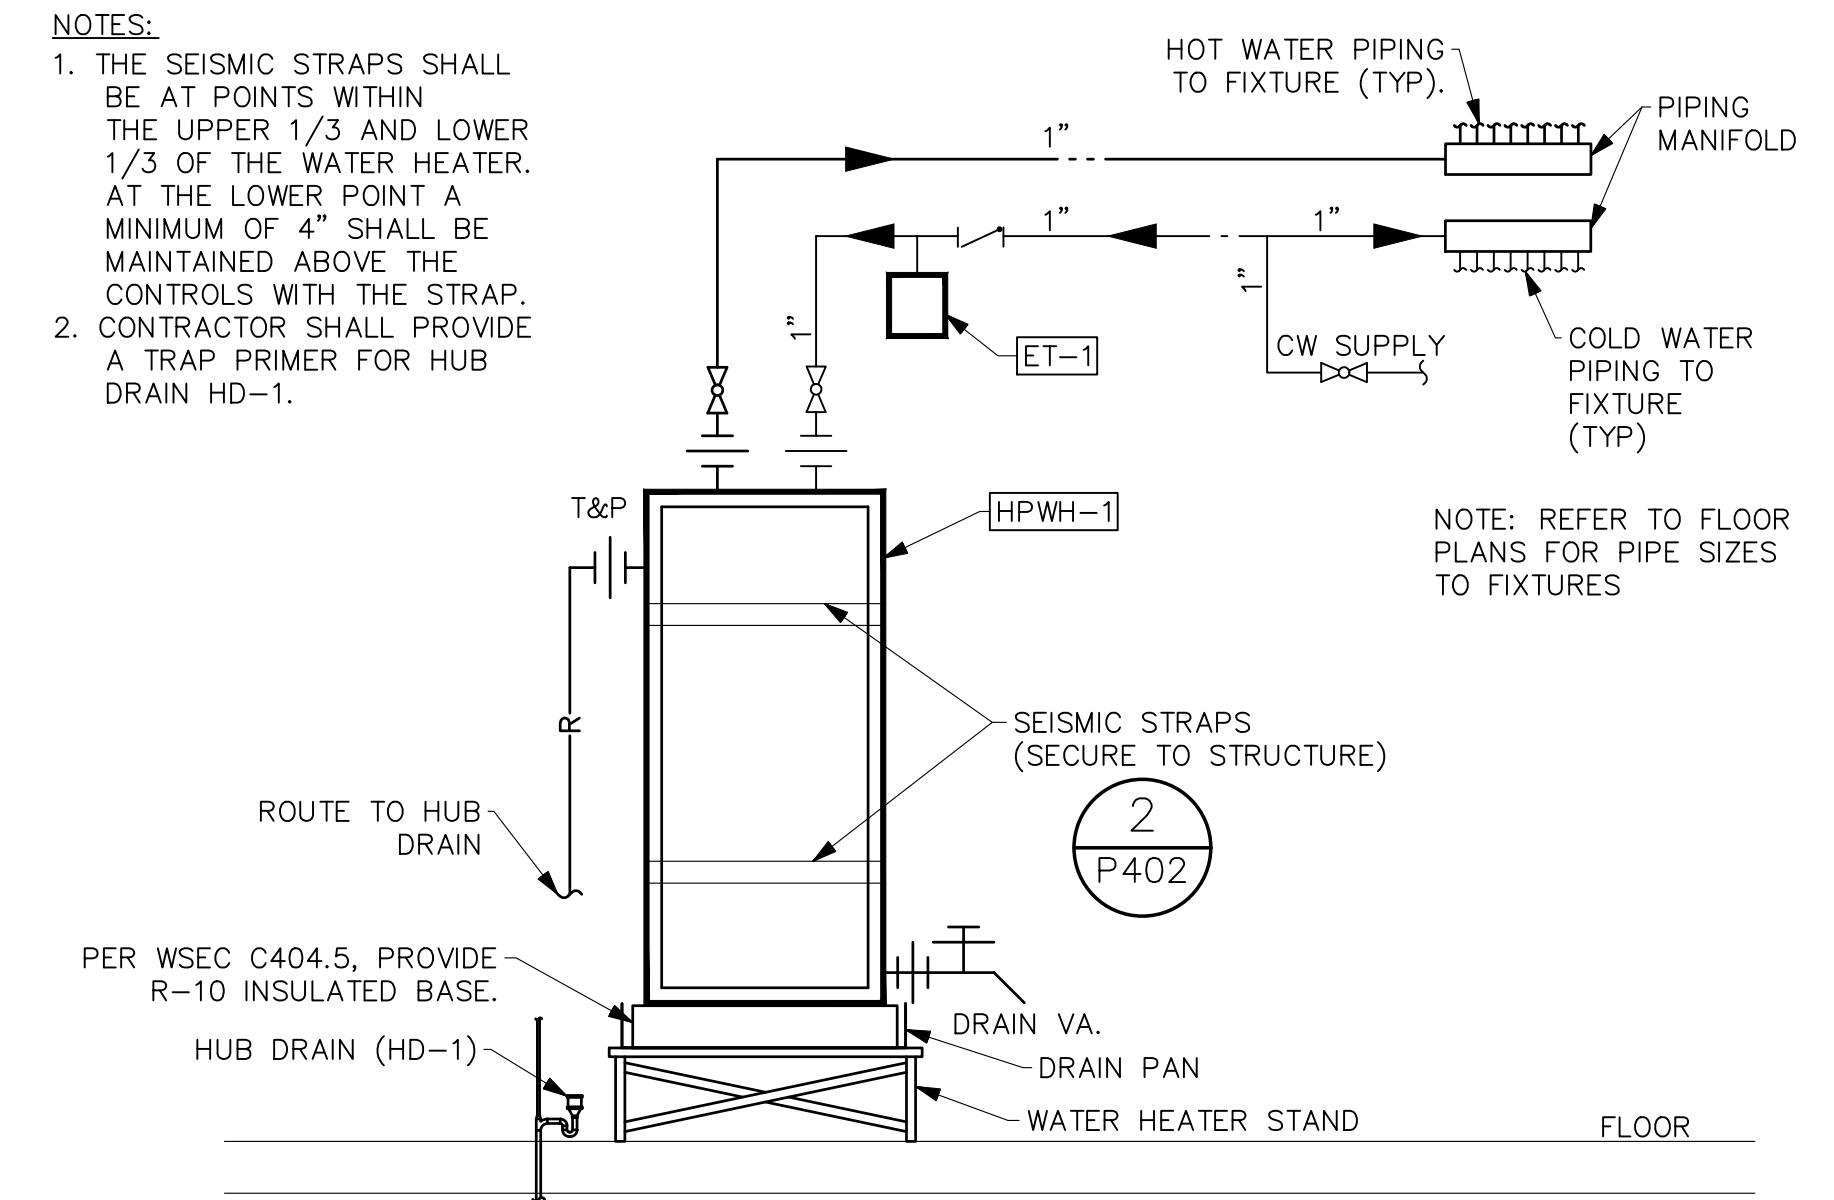


WATER HEATER

DETAIL

SCALE: NONE

1
P402

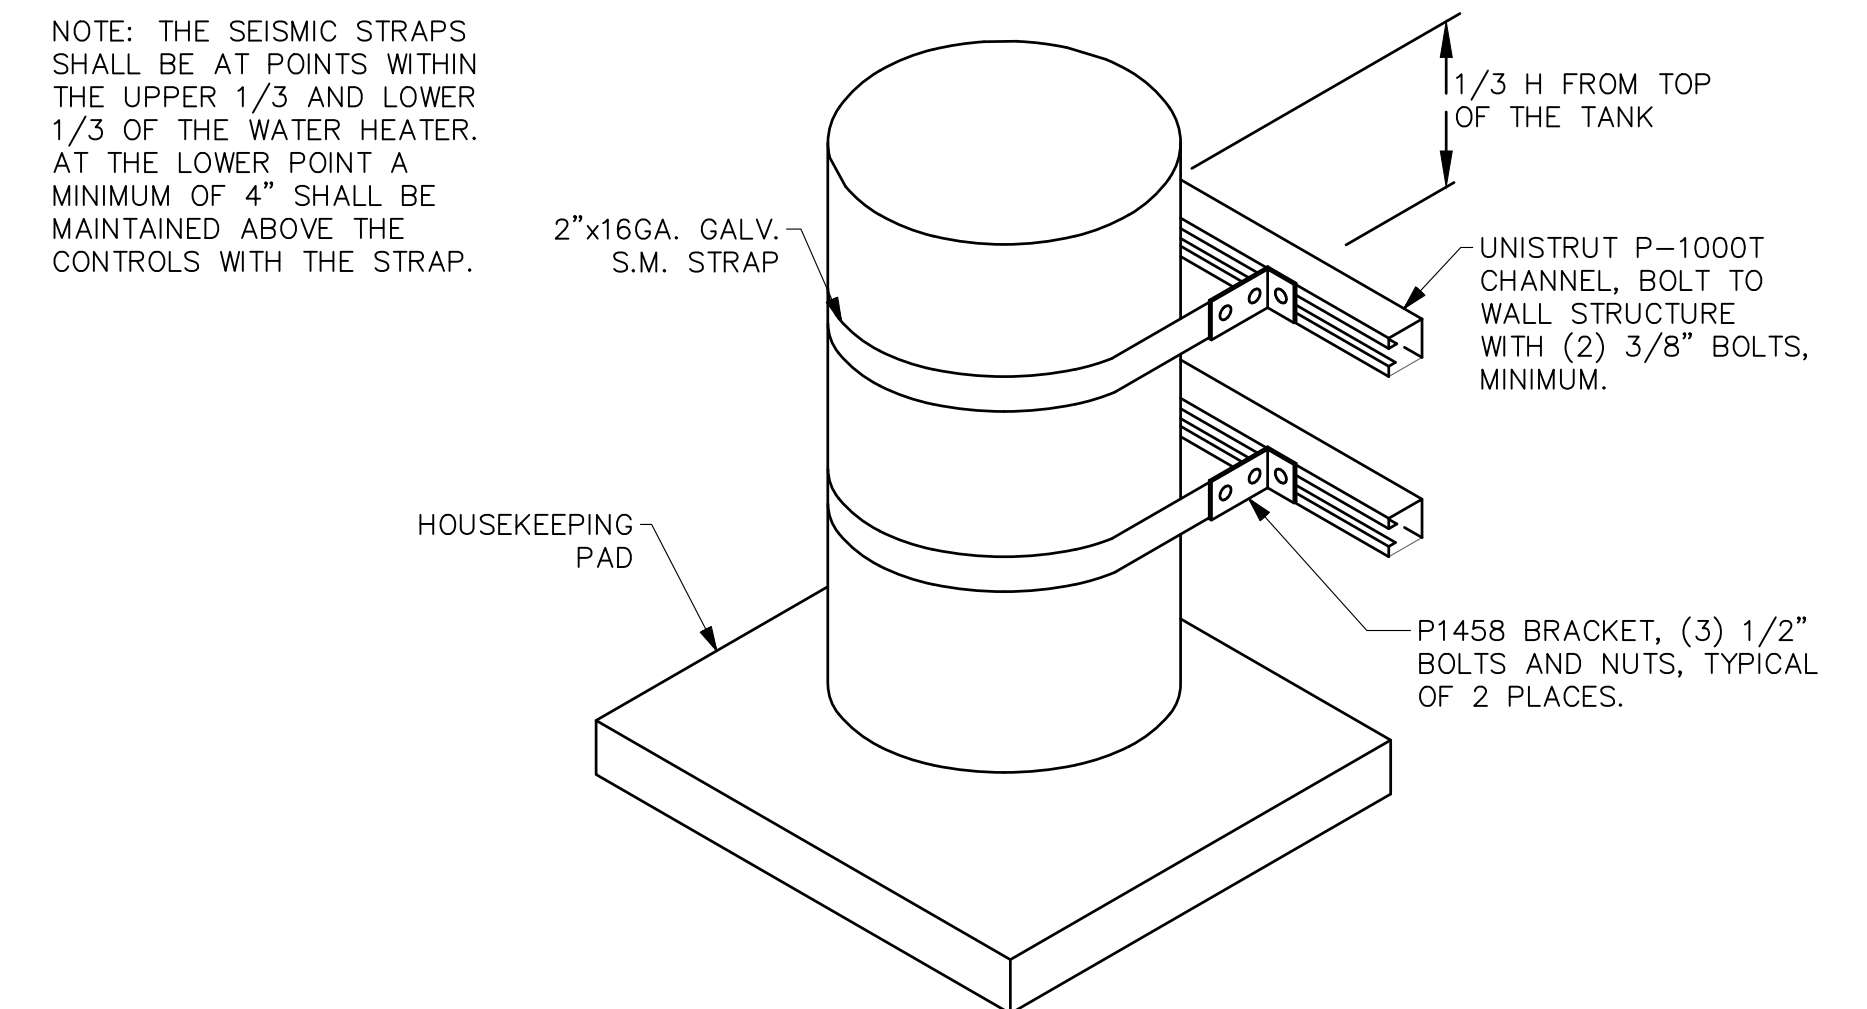


WATER HEATER SEISMIC STRAPPING

DETAIL

SCALE: NONE

2
P402

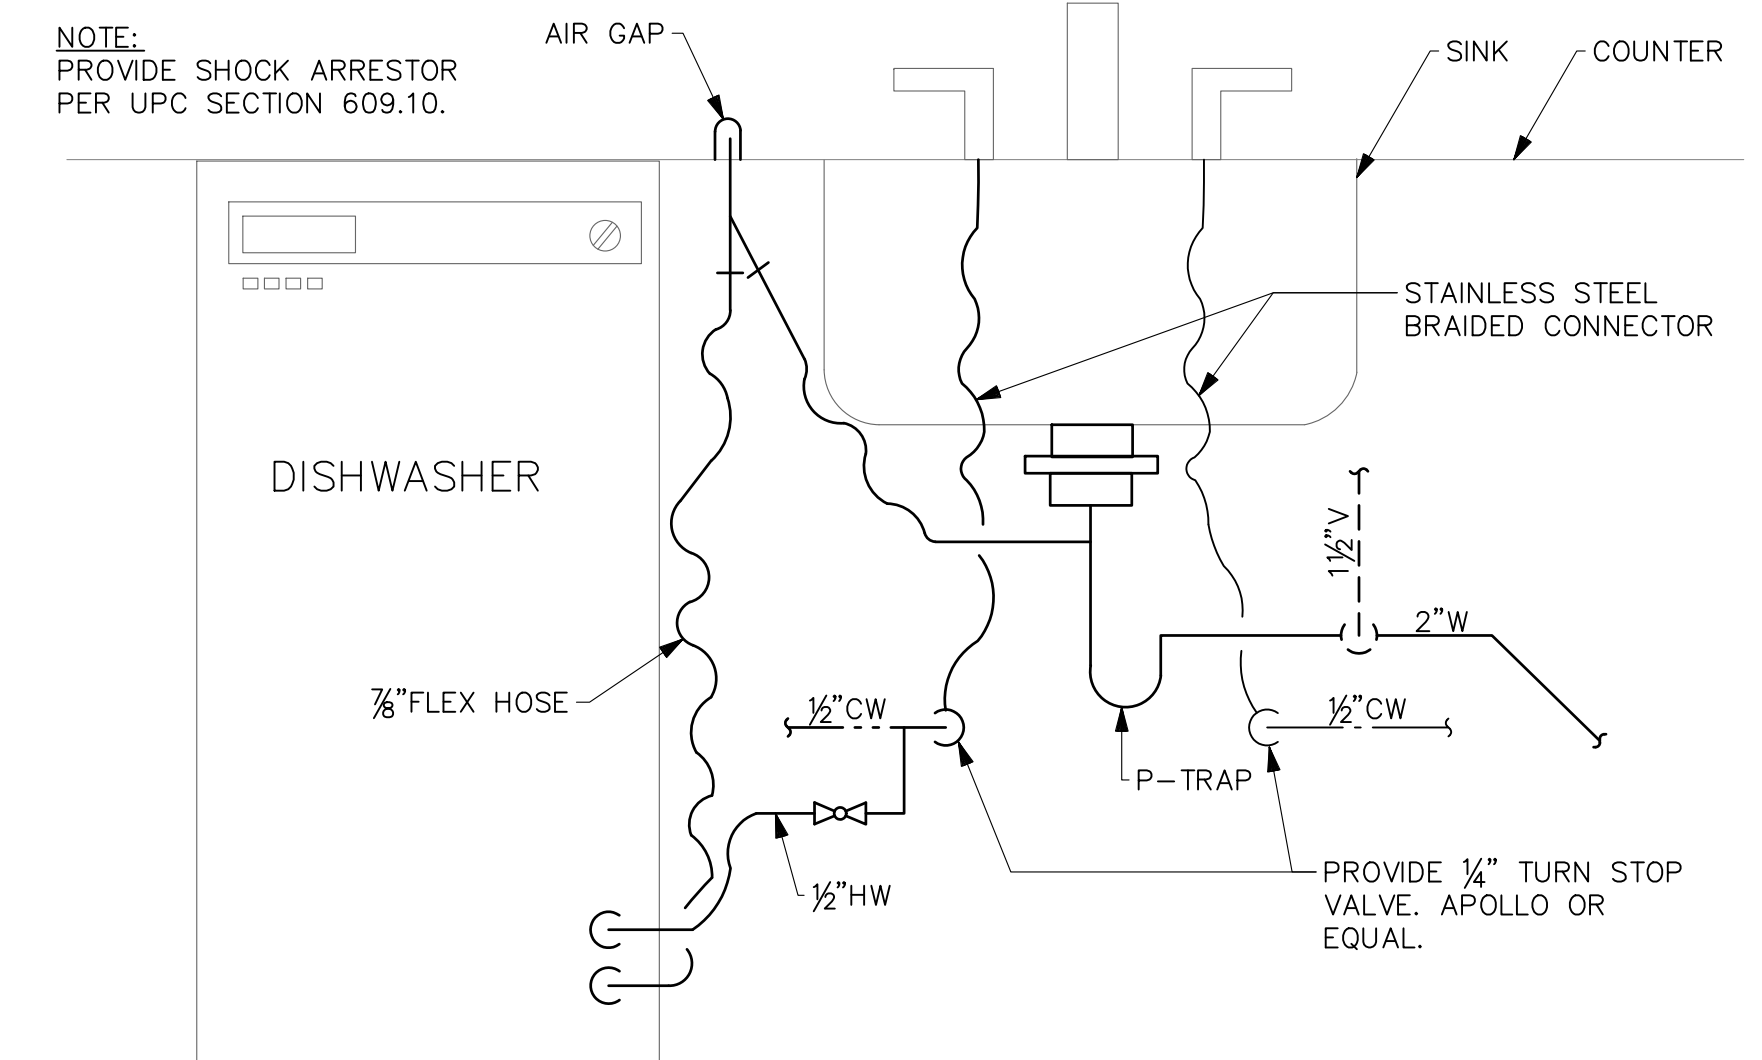



DISHWASHER CONNECTION

DETAIL

SCALE: NONE

3
P402

REVISIONS	DATE	DESCRIPTION
NO.		

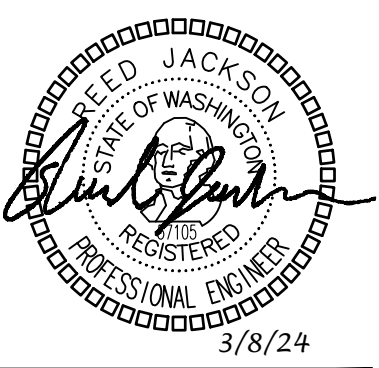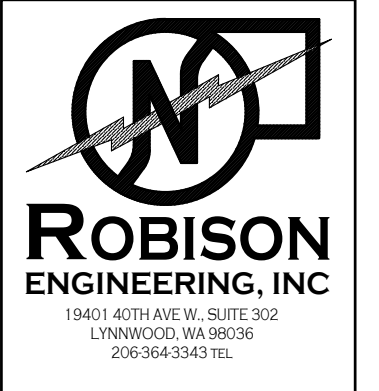

DRAWN:	JMN
DESIGNED:	JMN
CHECKED:	JMN
APPROVED:	JMN

PROJECT: EAST TOWN CROSSING - BUILDING F
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206/364-3343

ROBISON ENGINEERING, INC.

DATE: 3-8-2024

SHEET TITLE: DETAILS & DIAGRAMS

SHEET NO. P402

SYMBOLS

GENERAL

LIGHT LINE INDICATES NON-ELECTRICAL OR BACKGROUND (THIS IS NOT CONTRACTUAL DEFINITION OF WORK)
HEAVY LINE INDICATES NEW WORK (THIS IS NOT CONTRACTUAL DEFINITION OF WORK)

DETAIL IDENTIFICATION

SYMBOL **NAME**

1 FLAG NOTE

△ REVISION NOTE

☁ REVISION DEFINITION, AREA ENCLOSED CONTAINS DRAWING CHANGES MADE SUBSEQUENT TO PREVIOUS ISSUE

SWITCHES

\$_s SWITCH, SINGLE POLE; WITH SWITCHING SUBSCRIPT

\$_{os} OCCUPANCY SENSOR SWITCH

Ⓟ SWITCH, SINGLE POLE; WITH SWITCHING SUBSCRIPT "D" INDICATES WALLBOX DIMMER

Ⓞ CEILING MOUNTED OCCUPANCY SENSOR

\$_t SWITCH, TIMER.

\$_s SWITCH, THREE WAY.

RECEPTACLES

○ SINGLE RECEPTACLE

⊕ DUPLEX RECEPTACLE: WALL MOUNTED, +18" AFF

⊕_s CONTROLLED AND NON CONTROLLED DUPLEX RECEPTACLE (SPLIT WIRED RECEPTACLE)

⊕_c DUPLEX RECEPTACLE - ABOVE COUNTER

⊕_{GFCI} DUPLEX GFCI ABOVE COUNTER

⊕_{GFCI} DUPLEX GFCI

⊕_{+42"} DUPLEX RECEPTACLE, WITH HEIGHT ABOVE FINISHED FLOOR INDICATED

⊕_{ceiling} CEILING MOUNTED DUPLEX RECEPTACLE

⊕_{double} DOUBLE DUPLEX RECEPTACLE: WALL MOUNTED, +18" AFF

⊕_{floor} FLOOR BOX ONE DUPLEX RECEPTACLE

⊕_{floor+voice} FLOOR BOX ONE DUPLEX RECEPTACLE + ONE DATA + ONE VOICE

⊕_{special} SPECIAL PURPOSE RECEPTACLE, AS NOTED

MISCELLANEOUS

⊕ JUNCTION BOX: 4SQ MOUNTED

⊕_{wall} JUNCTION BOX: 4SQ WALL MOUNTED

⊕_{track} JUNCTION BOX: 4SQ TRACK

⊕_{mirror} CONNECTION FOR LIGHTED MIRROR COORDINATE LOCATION AND ELEVATION WITH ARCHITECT PRIOR TO ROUGH-IN

⊕_{thermo} THERMOSTAT

SIGNAL/COMMUNICATION

▽ DATA OUTLET: WALL MOUNTED ⊕ +18" AFF U.O.N.

▽_{phone} TELEPHONE/DATA OUTLET: WALL MOUNTED ⊕ +18" AFF U.O.N.

▽_{tv} TELEVISION OUTLET: WALL MOUNTED ⊕ +18" AFF U.O.N.

POWER

⊕_{panel} PANELBOARD

⊕_{wp} NON-FUSED DISCONNECT SWITCH (WP = NEMA 3R WHERE APPROPRIATE)

⊕_{fused} FUSED DISCONNECT SWITCH

⊕_{motor} MOTOR CONNECTION (EQUIPMENT NAME, HORSEPOWER, VOLTAGE, AND PHASE INDICATED)

⊕_{equip} EQUIPMENT CONNECTION (EQUIPMENT NAME, LOAD, VOLTAGE, AND PHASE INDICATED)

T TRANSFORMER, DRY TYPE, SHOWN TO SCALE

M KW METER AND BASE

PART OF THE DESIGN/BUILD FIRE ALARM SYSTEM

FACP FIRE ALARM SYSTEM CONTROL PANEL

P FIRE ALARM SYSTEM PULL STATION

⊕_{strobe} FIRE ALARM SYSTEM STROBE/SPEAKER

⊕_{smoke} FIRE ALARM PHOTOELECTRIC SMOKE DETECTOR AND SPEAKER.

⊕_{smoke+co} FIRE ALARM COMBINATION PHOTOELECTRIC SMOKE DETECTOR, CARBON MONOXIDE DETECTOR, AND SPEAKER, GUESTROOM.

⊕_{co} CARBON MONOXIDE DETECTOR.

⊕_{door} ELECTRO-MAGNETIC DOOR HOLDER

⊕_{smoke} DUCT SMOKE DETECTOR

ABBREVIATIONS

A AMPERE

AC ALTERNATING CURRENT, ABOVE COUNTER

AFF ABOVE FINISHED FLOOR

AIC AMPS INTERRUPTING CAPACITY

AL ALUMINUM

AMP AMPERE

AWG AMERICAN WIRE GAUGE

BKR BREAKER

BLDG BUILDING

C COIL or CONDUIT

CKT CIRCUIT

CO CONDUIT/RACEWAY ONLY

CT CURRENT TRANSFORMER

Cu COPPER

CW COOL WHITE

D DIMMER

DED DEDICATED

EC ELECTRICAL CONTRACTOR

EF EXHAUST FAN

EL ELECTRICAL

ELEC ELECTRICAL METALLIC TUBING

EMT EQUIPMENT

EXIST EXISTING

FAA FIRE ALARM ANNUNCIATOR

FACP FIRE ALARM CONTROL PANEL

FLUOR FLUORESCENT

GC GENERAL CONTRACTOR

GFCI GROUND FAULT CIRCUIT INTERRUPTER

GND GROUND

GRS GALVANIZED RIGID STEEL

HID HIGH INTENSITY DISCHARGE

HP HORSEPOWER

IG ISOLATED GROUND

KCMIL THOUSAND CIRCULAR MILLS

KVA KILOVOLT AMPERES

KW KILOWATT

LIGHT LIGHTING

LV LOW VOLTAGE

MFR MANUFACTURER

MIN MINIMUM

MLO MAIN LUGS ONLY

N NEUTRAL

NEC NATIONAL ELECTRICAL CODE (NFPA-70)

NEMA NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION

NTS NOT TO SCALE

PNL PANEL

POC POINT OF CONNECTION

PT POTENTIAL TRANSFORMER

PVC POLYVINYL CHLORIDE

PWR POWER

QTY QUANTITY

RECEPT RECEPTACLE

REF REFERENCE

RI ROUGH-IN

RM ROOM

RO RACEWAY ONLY

SHT SHEET

SPEC SPECIFICATIONS

SW SWITCH

SWBD SWITCHBOARD

SWGR SWITCHGEAR

TYP TYPICAL

UG UNDERGROUND

UL UNDERWRITERS LABORATORIES

UON UNLESS OTHERWISE NOTED

V VOLTS

W WATTS

WW WARM WHITE

WP WEATHERPROOF

W/ WITH

W/O WITHOUT

XFMR TRANSFORMER

XFR TRANSFER

Z IMPEDANCE OR ZONE

GENERAL NOTES

GENERAL

- PROVIDE ELECTRICAL INSTALLATION IN ACCORDANCE WITH THE GOVERNING ELECTRICAL CODE, LOCAL CODES, ORDINANCES AND REQUIREMENTS OF UTILITY COMPANIES FURNISHING SERVICES TO INSTALLATION.
- PROVIDE ALL WORK AND ITEMS NECESSARY FOR COMPLETE AND FUNCTIONAL ELECTRICAL SYSTEMS. THE ELECTRICAL DRAWINGS ARE DIAGRAMMATIC AND DO NOT NECESSARILY SHOW EVERY CONDUIT, BOX, CONDUCTOR OR SIMILAR ITEMS FOR A COMPLETE INSTALLATION.
- THE CONTRACTOR SHALL VISIT THE SITE PRIOR TO BID AND DETERMINE CONDITIONS WHICH MAY AFFECT BID. ANY ITEMS NOT FULLY UNDERSTOOD SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT PRIOR TO BIDDING.
- "REF" INDICATIONS DENOTE WORK COVERED ELSEWHERE (ARCHITECTURAL, STRUCTURAL, OR MECHANICAL).
- REFERENCE ARCHITECTURAL DRAWING FOR EXACT LOCATION OF DEVICES. QUESTIONS CONCERNING THE LOCATION OF DEVICES AND EQUIPMENT SHALL BE DIRECTED TO THE ARCHITECT. FAILURE TO COORDINATE REQUIREMENTS SHALL IN NO WAY RESULT IN ADDITIONAL COMPENSATION BEING PROVIDED TO THE CONTRACTOR.
- WHEREVER THE WORD "PROVIDE" IS USED, IT MEANS, "FURNISH AND INSTALL COMPLETE AND READY FOR USE."
- COORDINATE LOCATION OF ELECTRICAL WITH OTHER TRADES.
- REFER TO EQUIPMENT DRAWINGS FOR MECHANICAL CHARACTERISTICS (SIZE, LOCATION, ETC.) OF MECHANICAL EQUIPMENT, UNLESS OTHERWISE INDICATED. COORDINATE INSTALLATION AND LOCATION OF ALL EQUIPMENT WITH MECHANICAL CONTRACTOR. VERIFY ALL FUSE RATINGS, WIRE SIZES AND DISCONNECT SIZES PRIOR TO INSTALLATION.

MATERIALS AND METHODS

- PROVIDE RACEWAY AND WIRING ROUTED CONCEALED WITHIN BUILDING STRUCTURE WHERE POSSIBLE. WHERE RACEWAY CANNOT BE CONCEALED, IT SHALL BE INSTALLED PER PROJECT MANAGER'S DIRECTION. ALL CONDUIT SHALL BE INSTALLED IN NEAT SYMMETRICAL LINES HORIZONTAL OR PERPENDICULAR TO BUILDING COLUMNS AND ROOF LINES. CONDUITS SHALL BE GROUPED ON COMMON SUPPORTS WHEREVER POSSIBLE.
- EXPOSED CONDUIT ROUTING: CONDUITS MAY BE ROUTED EXPOSED IN MECHANICAL AND ELECTRICAL ROOMS ONLY. EXPOSED CONDUITS SHALL BE SECURED A MINIMUM OF 6" ABOVE FLOOR.
- OUTDOOR EXPOSED CONDUIT ROUTING: CONDUITS ROUTED ON ROOF OR EXPOSED TO WEATHER SHALL BE GRC, PVC OR LIQUID-TIGHT FLEX. PROVIDE WATER-TIGHT CONNECTIONS AND FITTINGS.
- CLEARANCES: VERIFY PHYSICAL DIMENSIONS OF EQUIPMENT TO ENSURE THAT ACCESS CLEARANCES CAN BE MET.
- CONNECTIONS: PROVIDE GRS, METALLIC FLEX, OR LIQUIDTITE FLEX CONDUITS FOR CONNECTIONS TO MOTORS OR MOTORIZED EQUIPMENT.
- WIRING: PROVIDE MINIMUM #12 AWG WIRE SIZE. IF CONDUIT IS TO BE USED MINIMUM IS TO BE 1/2". FLEXIBLE CONDUIT AND FLEXIBLE CABLE IS PERMISSIBLE THROUGHOUT THE BUILDING.

- WIRING: PROVIDE MINIMUM #10 AWG COPPER CONDUCTOR SIZE IN 120V BRANCH CIRCUIT RUNS OVER 75' IN LENGTH.
- TRENCHING: COORDINATE ALL TRENCHING WORK WITH OTHER UTILITY LOCATIONS AND DRAINAGE TRENCHES.
- UNDERGROUND CONDUITS: PROVIDE PVC, SCHEDULE 40, 3/4" MINIMUM. PROVIDE GRC CONDUIT TRANSITION ELBOW WHEN TURNING UP TO ABOVE GRADE.
- DIRECT-BURIED CONDUITS: CONDUIT FOR BRANCH CIRCUITS OUTSIDE BUILDINGS NOT BENEATH DRIVEWAYS OR PARKING AREAS SHALL BE DIRECTLY BURIED WITHOUT CONCRETE ENCASEMENT. THE DEPTH TO THE TOP OF BURIED CONDUITS SHALL BE 36". PROVIDE MARKER TAPE 12" BELOW GRADE.
- BELOW SLAB: CONDUIT ROUTED BELOW ON-GRADE FLOOR SLABS SHALL BE INSTALLED PRIOR TO FLOOR SLAB POUR. ROUTE CONDUITS BELOW SLAB AS STRAIGHT AS POSSIBLE TO MINIMIZE BENDS.
- ALL CONDUITS PENETRATING THE BUILDING ENVELOPE BELOW GRADE SHALL FOLLOW WATERPROOFING REQUIREMENTS IN THE ARCHITECTURAL DRAWINGS.

NEUTRALS

- AT CONTRACTORS OPTION, NEUTRALS MAY BE SHARED ON COMBINED HOMERUNS UNLESS THE CIRCUIT HAS A GFCI BREAKER, AN ISOLATED GROUND, OR IS FROM A PANEL WITH TVSS PROTECTION. ANY NEUTRAL DOWNSTREAM FROM A DIMMER SHALL BE DEDICATED TO THE DIMMED LOAD.
- NEUTRAL WIRES SHOWN FOR TWO AND THREE POLE MECHANICAL AND KITCHEN EQUIPMENT MAY BE OMITTED UPON VERIFICATION THAT THEY ARE NOT REQUIRED EITHER FOR OPERATION OR CONTROL CIRCUITS PER MANUFACTURER'S SPECIFICATIONS.

LIGHTING

- PROVIDE LIGHT FIXTURES WITH PROPER FITTING FLANGES, MOUNTING SUPPORTS, AND ACCESSORY ITEMS, UL LISTED FOR CONDITIONS OF USE.

LOW VOLTAGE LIGHTING

- PROVIDE LOW VOLTAGE TRANSFORMERS IN NEARBY ACCESSIBLE CEILING SPACE.
- PROVIDE LOW VOLTAGE CONDUCTORS SIZED PER MANUFACTURER'S GUIDELINES TO MINIMIZE VOLTAGE DROP.

LIGHTING CONTROL

- THE MAXIMUM LIGHTING POWER THAT MAY BE CONTROLLED FROM A SINGLE SWITCH OR AUTOMATIC CONTROL SHALL NOT EXCEED THAT WHICH IS PROVIDED BY A TWENTY AMPERE CIRCUIT LOADED TO NOT MORE THAN EIGHTY PERCENT. A MASTER CONTROL MAY BE INSTALLED PROVIDED THE INDIVIDUAL SWITCHES RETAIN THEIR CAPABILITY TO FUNCTION INDEPENDENTLY.
- EMERGENCY FIXTURES: EMERGENCY BATTERY/CHARGER SHALL BE CONNECTED TO AN UNSWITCHED LEG OF THE DESIGNATED CIRCUIT.

GENERAL REQUIREMENTS

- DRAWINGS ARE DIAGRAMMATIC, SHOWING THE GENERAL LOCATION, TYPE, LAYOUT, AND EQUIPMENT REQUIRED.
- THE DRAWINGS SHALL NOT BE SCALED FOR EXACT MEASUREMENT.
- REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS.
- REFER TO MANUFACTURER'S STANDARD INSTALLATION DRAWINGS FOR EQUIPMENT CONNECTIONS AND INSTALLATION REQUIREMENTS.
- PROVIDE CONNECTIONS, ACCESSORIES, OFFSETS, AND MATERIALS NECESSARY FOR A COMPLETE SYSTEM.

CONTRACTOR SUBSTITUTIONS & REVISIONS

- PLEASE SUBMIT PROPOSALS FOR SUBSTITUTIONS OR REVISIONS FOR REVIEW AND APPROVAL PRIOR TO ORDERING MATERIAL OR DOING WORK.
- FOR EQUIPMENT THAT IS SCHEDULED BY MANUFACTURER'S NAME AND CATALOG DESIGNATIONS, THE MANUFACTURER'S PUBLISHED DATA AND/OR SPECIFICATION FOR THAT ITEM ARE CONSIDERED PART OF SPECIFICATION.
- ENGINEERING COSTS FOR REVISING MEP PLANS SHALL BE ADDRESSED IN THE COST ANALYSIS OF THE SUBSTITUTION PROPOSAL.
- CONTRACTOR TO COORDINATE WITH ENGINEER AND DETERMINE ASSOCIATED DESIGN AND PERMITTING COSTS. CONTRACTOR SHALL BE RESPONSIBLE FOR OTHER COSTS ASSOCIATED WITH UNFORESEEN ISSUES RESULTING FROM SUBSTITUTIONS OR REVISIONS.

PRE-CON MEETING NOTES

CONTRACTORS SHALL ATTEND A PRE-CONSTRUCTION MEETING WITH THE ENGINEER FOR THE PURPOSE OF REVIEWING THE WORK PRIOR TO ORDERING ANY EQUIPMENT OR PERFORMING ANY WORK. THE MEETING SHALL BE LOCATED AT THE PROJECT SITE ON A DATE AND TIME TO BE MUTUALLY AGREED. THE MEETING WILL BE A WORKING SESSION. THE MEETING WILL BE FACILITATED BY THE ENGINEER AND THE AGENDA WILL INCLUDE A DETAILED REVIEW OF THE PLANS AND SPECIFICATIONS, CROSS CHECK WITH OTHER TRADES FOR COORDINATION ISSUES, REVIEW OF PROPOSED PRODUCTS, REVIEW OF PLANNED MEANS AND METHODS, AND ON-SITE INVESTIGATION OF FIELD CONDITIONS RELATIVE TO EXISTING CONDITIONS THAT COULD AFFECT THE WORK. PERSONS ATTENDING THE MEETING SHALL BE KNOWLEDGEABLE OF THE PROJECT AND SHALL BE THE SPECIFIC PERSONS INTENDED TO CONTINUE WITH THE PROJECT THROUGH TO COMPLETION. IF REQUIRED, REVISED PLANS WILL BE ISSUED THROUGH OFFICIAL CHANNELS. CHANGES IN THE BID PRICE WILL BE DISCUSSED, BUT NO CHANGE ORDERS WILL BE ISSUED UNLESS PROCESSED THROUGH OFFICIAL CHANNELS. IT SHALL BE UNDERSTOOD THAT THE ENGINEER HAS NO AUTHORITY TO ISSUE CHANGE ORDERS.


THE FOLLOWING TRADES SHALL BE REPRESENTED FOR THE MINIMUM TIME INDICATED:

MECHANICAL SHEET METAL	4 HOURS
PLUMBING/PIPING	4 HOURS
ELECTRICAL	4 HOURS
SPRINKLER	2 HOURS
GENERAL CONTRACTOR	ALL SESSIONS

DRAWING INDEX

DWG	DESCRIPTION	PERMIT SET 03/08/24	INCLUDED IN SET																			
			1	2	3	4	5	6	7	8	9	10	11	12								
E0.00	LEGEND, GENERAL NOTES, DRAWING INDEX	X																				
E0.02	SITE POWER PLAN	X																				
E0.03	SITE LIGHTING PLAN	X																				
E1.01	LIGHTING PLAN - LEVEL 1	X																				
E1.02	LIGHTING PLAN - LEVEL 2	X																				
E1.03	LIGHTING PLAN - LEVEL 3	X																				
E1.10	PHOTOMETRIC PLAN - LEVEL 1	X																				
E1.50	LIGHTING NOTES & LUMINAIRE SCHEDULE	X																				
E3.00	POWER PLAN - LEVEL 1	X																				
E3.01	POWER PLAN - LEVEL 2	X																				
E3.02	POWER PLAN - LEVEL 3	X																				
E5.00	UNIT PLAN NOTES	X																				
E5.01	UNIT PLANS	X																				
E6.00	ONE-LINE DIAGRAM & PANEL SCHEDULES	X																				
E6.01	PANEL SCHEDULES	X																				

REV. NO.	DATE	DESCRIPTION

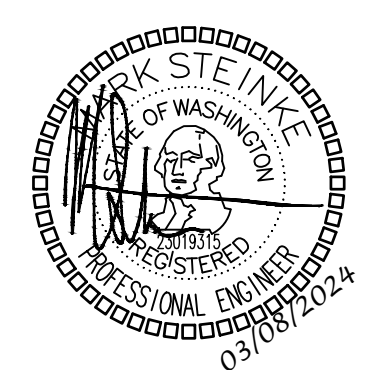

DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: EAST TOWN CROSSING BUILDING F
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-864-3343

ROBISON ENGINEERING, INC.


PERMIT SET
03/08/2024

SHEET TITLE:
**LEGEND,
GENERAL
NOTES,
DRAWING INDEX**


SHEET NO.
E0.00

GENERAL NOTES

1. MOUNTING HEIGHT (MH) LISTED IN LUMINAIRE SCHEDULE SHALL BE FROM ABOVE GRADE TO BOTTOM OF COMPLETE EXPOSED FIXTURE.
2. ALL EXTERIOR MOUNTED LIGHTING SHALL BE CONTROLLED BY PHOTOCONTROL OR ASTRONOMIC TIME-CLOCK SCHEDULING PER CALIFORNIA ENERGY CODE (CENC) REQUIREMENTS 160.5(c)2. PROVIDE MOTION SENSING CONTROLS FOR LUMINAIRES OVER 40 WATTS MOUNTED LESS THAN 24' ABOVE GRADE AND WALL MOUNTED LUMINAIRES MORE THAN 24' ABOVE GRADE.
3. ALL EXTERIOR MOUNTED LUMINAIRES SHALL FOLLOW MAXIMUM ALLOWABLE BACKLIGHT, UPLIGHT AND GLARE (BUG) RATINGS FOUND IN CALIFORNIA GREEN BUILDING STANDARDS CODE TABLE 5.106.8.
4. DURING EMERGENCY CONDITIONS EMERGENCY LIGHTING CIRCUITS SHALL BYPASS ALL LIGHTING CONTROLS IN ORDER TO ENERGIZE ALL CONNECTED LUMINAIRES AT FULL CAPACITY. PROVIDE UL924 RELAYS AS REQUIRED TO BYPASS AREA CONTROLS.
 - 4.1. EMERGENCY PATHWAY EGRESS LIGHTING: EMERGENCY LIGHTING FACILITIES SHALL BE ARRANGED TO PROVIDE INITIAL ILLUMINATION THAT IS NOT LESS THAN AN AVERAGE OF 1 FOOTCANDLE. (CBC 1008.3.5)

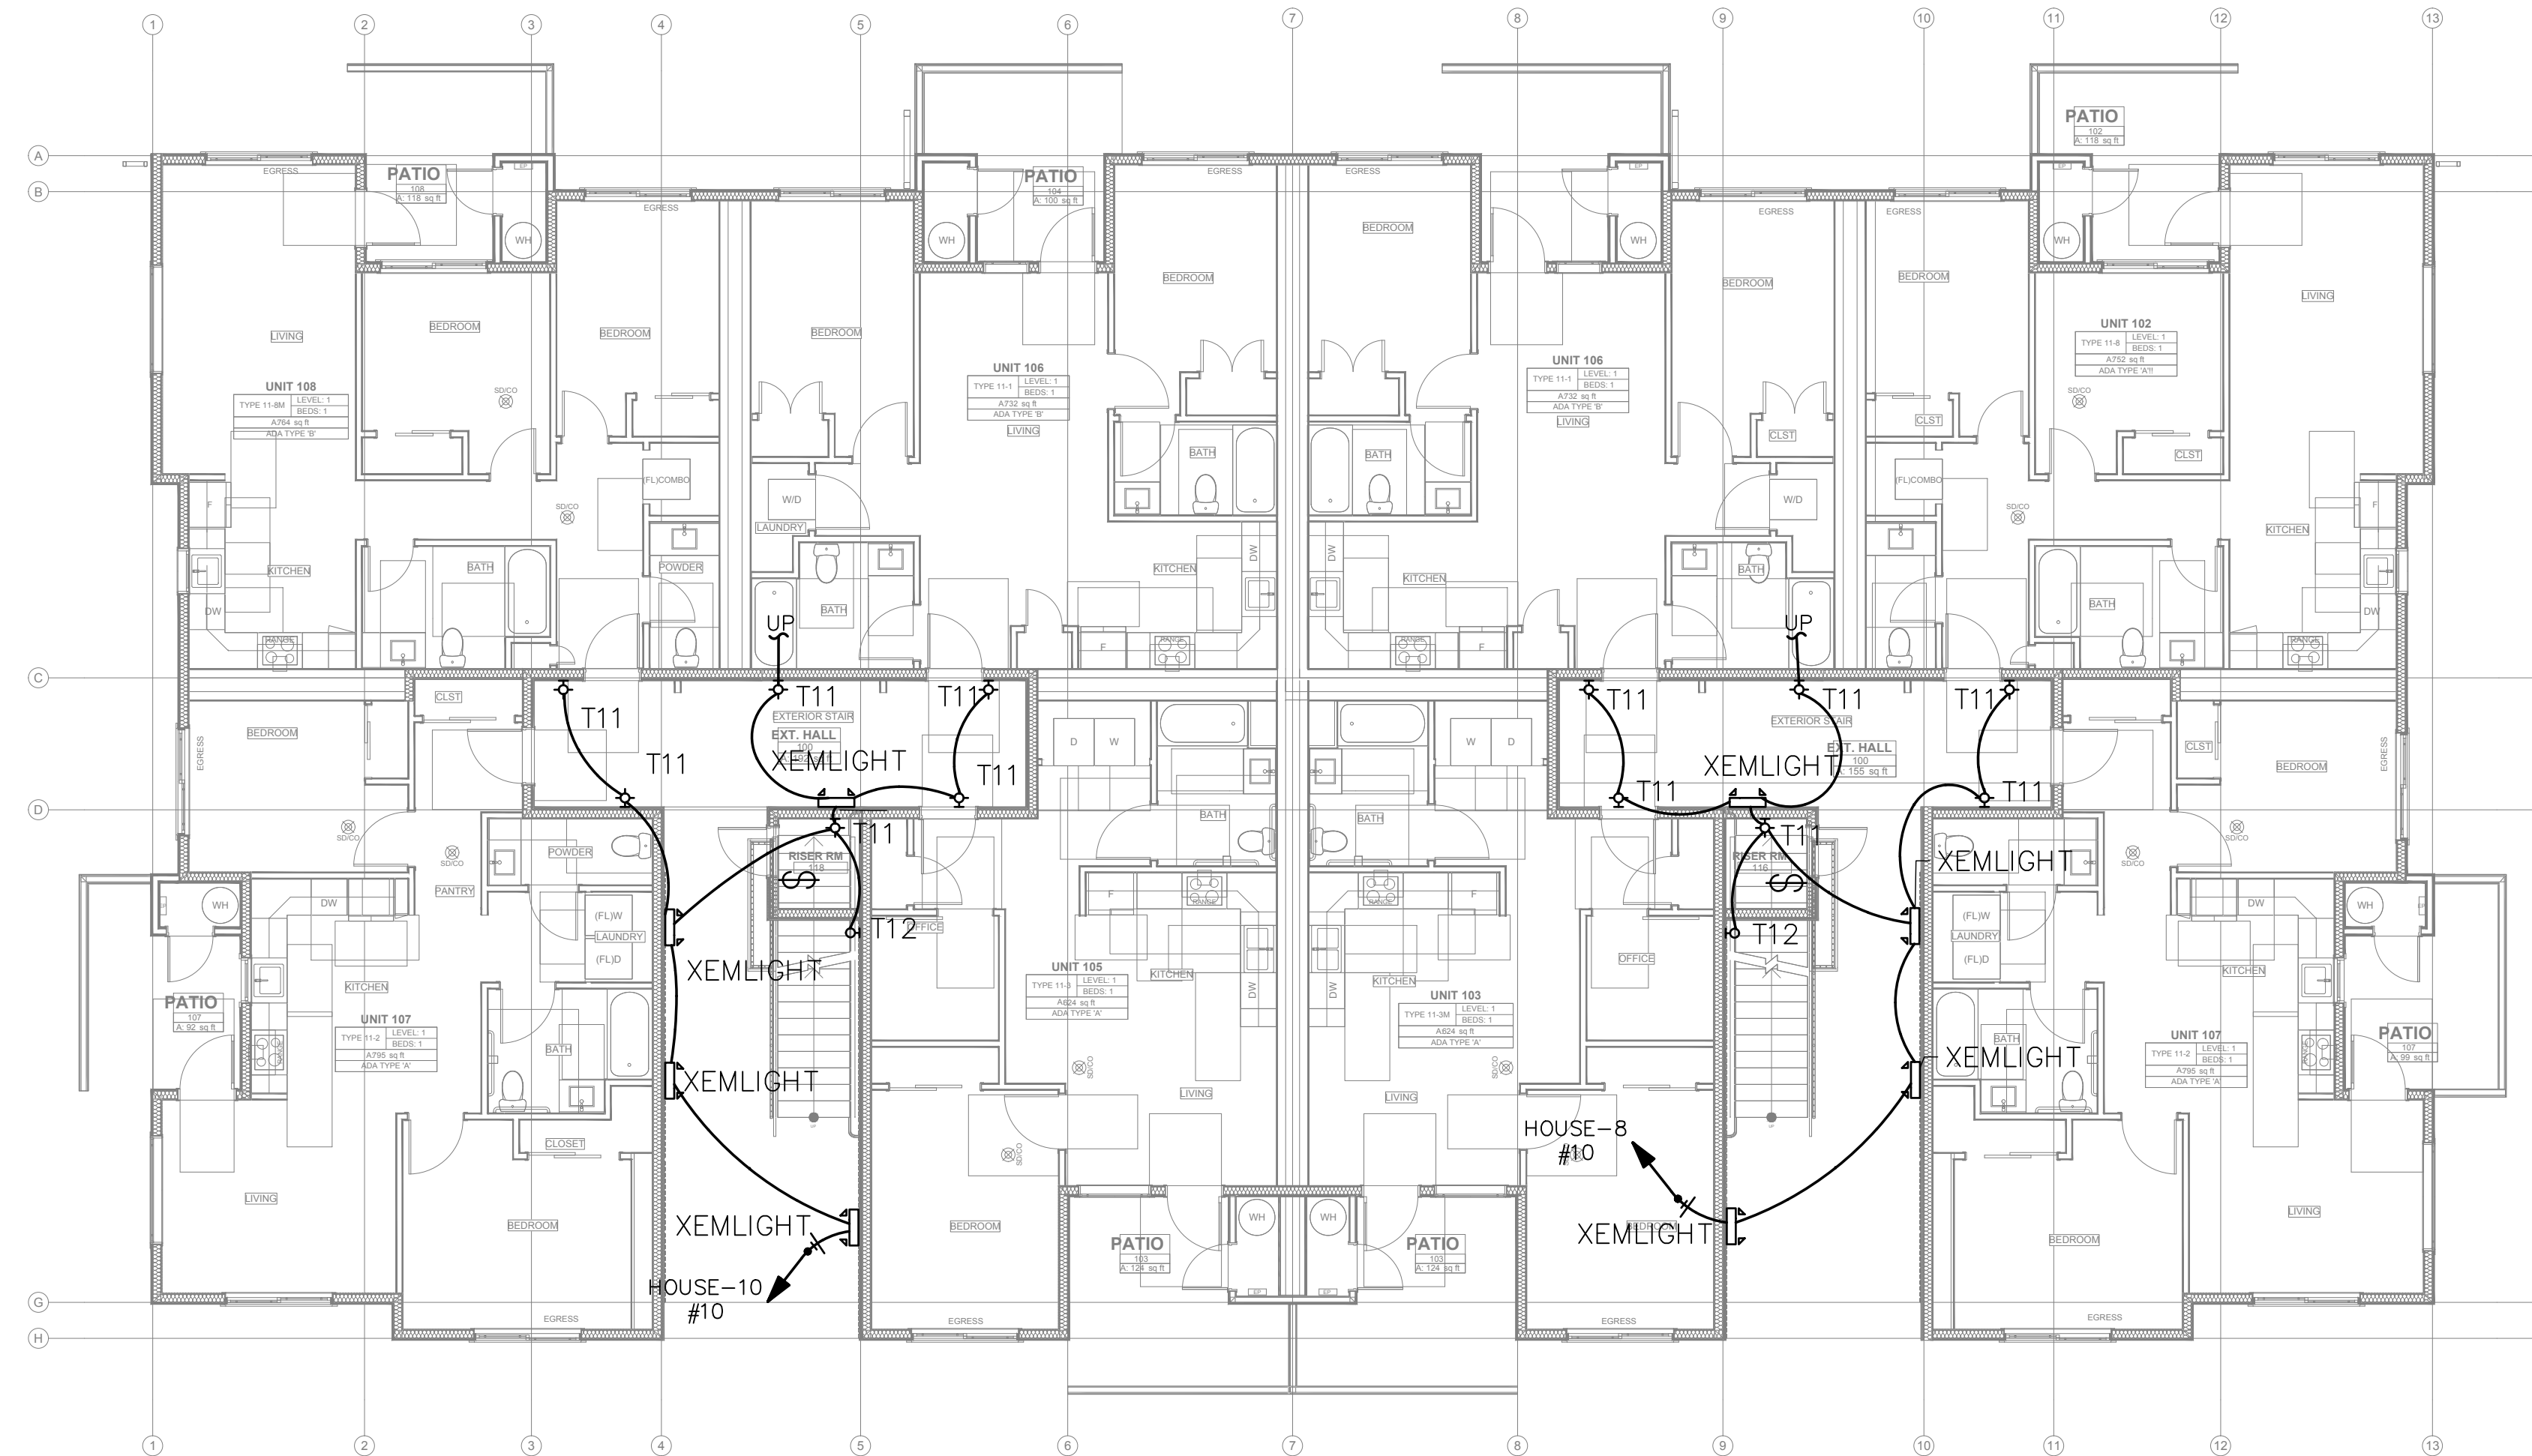

NO.	DATE	DESCRIPTION

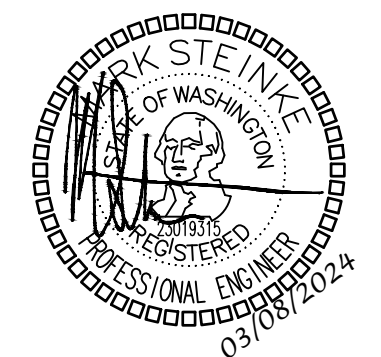

DRAWN:	LYSAK K.
DESIGNED:	LYSAK K.
CHECKED:	STEINKE M.
APPROVED:	STEINKE M.

PROJECT: **EAST TOWN CROSSING BUILDING F**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-845-6116


ROBISON ENGINEERING, INC

PERMIT SET
 03/08/2024

SHEET TITLE:
LIGHTING PLAN - LEVEL 1


SHEET NO.
 E1.01

LIGHTING PLAN — LEVEL 1
 SCALE: 1/8" = 1'-0"




GENERAL NOTES

1. MOUNTING HEIGHT (MH) LISTED IN LUMINAIRE SCHEDULE SHALL BE FROM ABOVE GRADE TO BOTTOM OF COMPLETE EXPOSED FIXTURE.
2. ALL EXTERIOR MOUNTED LIGHTING SHALL BE CONTROLLED BY PHOTOCONTROL OR ASTRONOMIC TIME-CLOCK SCHEDULING PER CALIFORNIA ENERGY CODE (CEC) REQUIREMENTS 160.5(c)2. PROVIDE MOTION SENSING CONTROLS FOR LUMINAIRES OVER 40 WATTS MOUNTED LESS THAN 24' ABOVE GRADE AND WALL MOUNTED LUMINAIRES MORE THAN 24' ABOVE GRADE.
3. ALL EXTERIOR MOUNTED LUMINAIRES SHALL FOLLOW MAXIMUM ALLOWABLE BACKLIGHT, UPLIGHT AND GLARE (BUG) RATINGS FOUND IN CALIFORNIA GREEN BUILDING STANDARDS CODE TABLE 5.106.8.
4. DURING EMERGENCY CONDITIONS EMERGENCY LIGHTING CIRCUITS SHALL BYPASS ALL LIGHTING CONTROLS IN ORDER TO ENERGIZE ALL CONNECTED LUMINAIRES AT FULL CAPACITY. PROVIDE UL924 RELAYS AS REQUIRED TO BYPASS AREA CONTROLS.
 - 4.1. EMERGENCY PATHWAY EGRESS LIGHTING: EMERGENCY LIGHTING FACILITIES SHALL BE ARRANGED TO PROVIDE INITIAL ILLUMINATION THAT IS NOT LESS THAN AN AVERAGE OF 1 FOOTCANDLE. (CBC 1008.3.5)

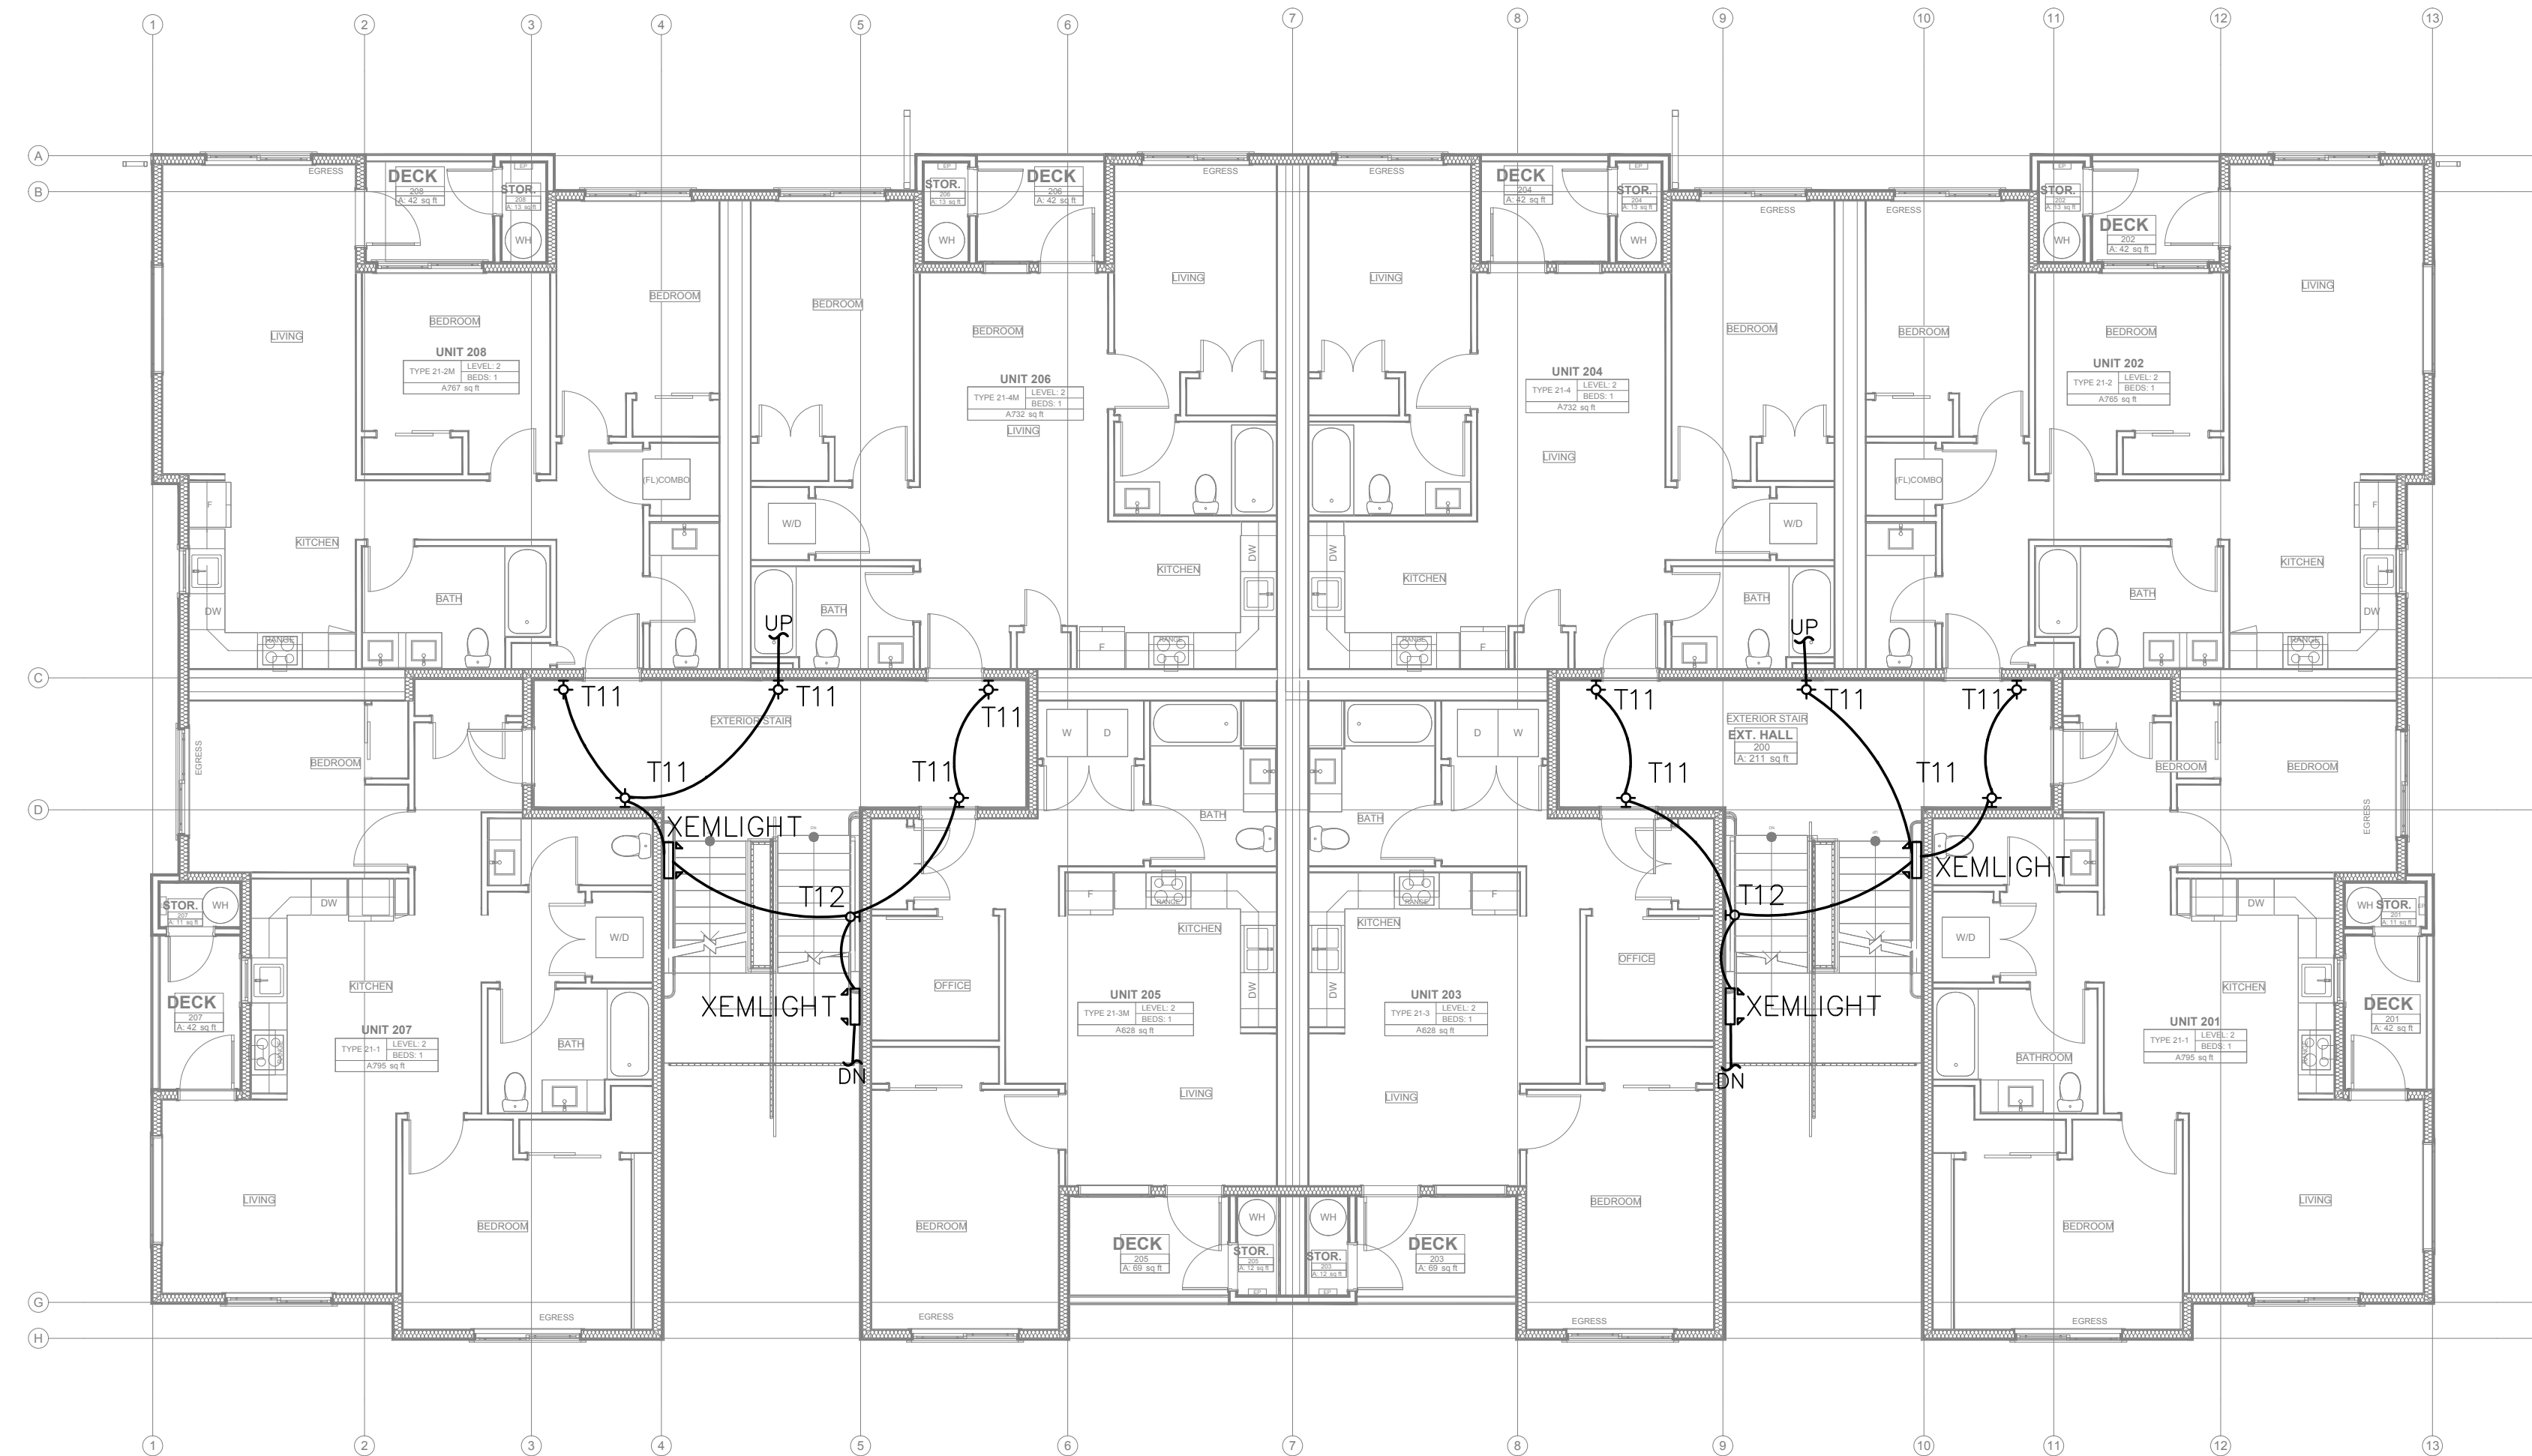

NO.	DATE	DESCRIPTION

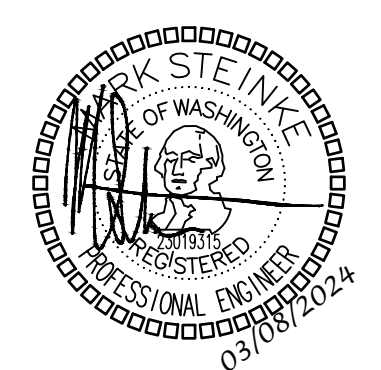

DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: **EAST TOWN CROSSING BUILDING F**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-834-5161


ROBISON ENGINEERING, INC.

PERMIT SET
 03/08/2024

SHEET TITLE:
LIGHTING PLAN - LEVEL 2


SHEET NO.
 E1.02

LIGHTING PLAN - LEVEL 2
 SCALE: 1/8" = 1'-0" 0' 4' 8' 16'




GENERAL NOTES

1. MOUNTING HEIGHT (MH) LISTED IN LUMINAIRE SCHEDULE SHALL BE FROM ABOVE GRADE TO BOTTOM OF COMPLETE EXPOSED FIXTURE.
2. ALL EXTERIOR MOUNTED LIGHTING SHALL BE CONTROLLED BY PHOTOCONTROL OR ASTRONOMIC TIME-CLOCK SCHEDULING PER CALIFORNIA ENERGY CODE (CEC) REQUIREMENTS 160.5(c)2. PROVIDE MOTION SENSING CONTROLS FOR LUMINAIRES OVER 40 WATTS MOUNTED LESS THAN 24' ABOVE GRADE AND WALL MOUNTED LUMINAIRES MORE THAN 24' ABOVE GRADE.
3. ALL EXTERIOR MOUNTED LUMINAIRES SHALL FOLLOW MAXIMUM ALLOWABLE BACKLIGHT, UPLIGHT AND GLARE (BUG) RATINGS FOUND IN CALIFORNIA GREEN BUILDING STANDARDS CODE TABLE 5.106.8.
4. DURING EMERGENCY CONDITIONS EMERGENCY LIGHTING CIRCUITS SHALL BYPASS ALL LIGHTING CONTROLS IN ORDER TO ENERGIZE ALL CONNECTED LUMINAIRES AT FULL CAPACITY. PROVIDE UL924 RELAYS AS REQUIRED TO BYPASS AREA CONTROLS.
 - 4.1. EMERGENCY PATHWAY EGRESS LIGHTING: EMERGENCY LIGHTING FACILITIES SHALL BE ARRANGED TO PROVIDE INITIAL ILLUMINATION THAT IS NOT LESS THAN AN AVERAGE OF 1 FOOTCANDLE. (CBC 1008.3.5)

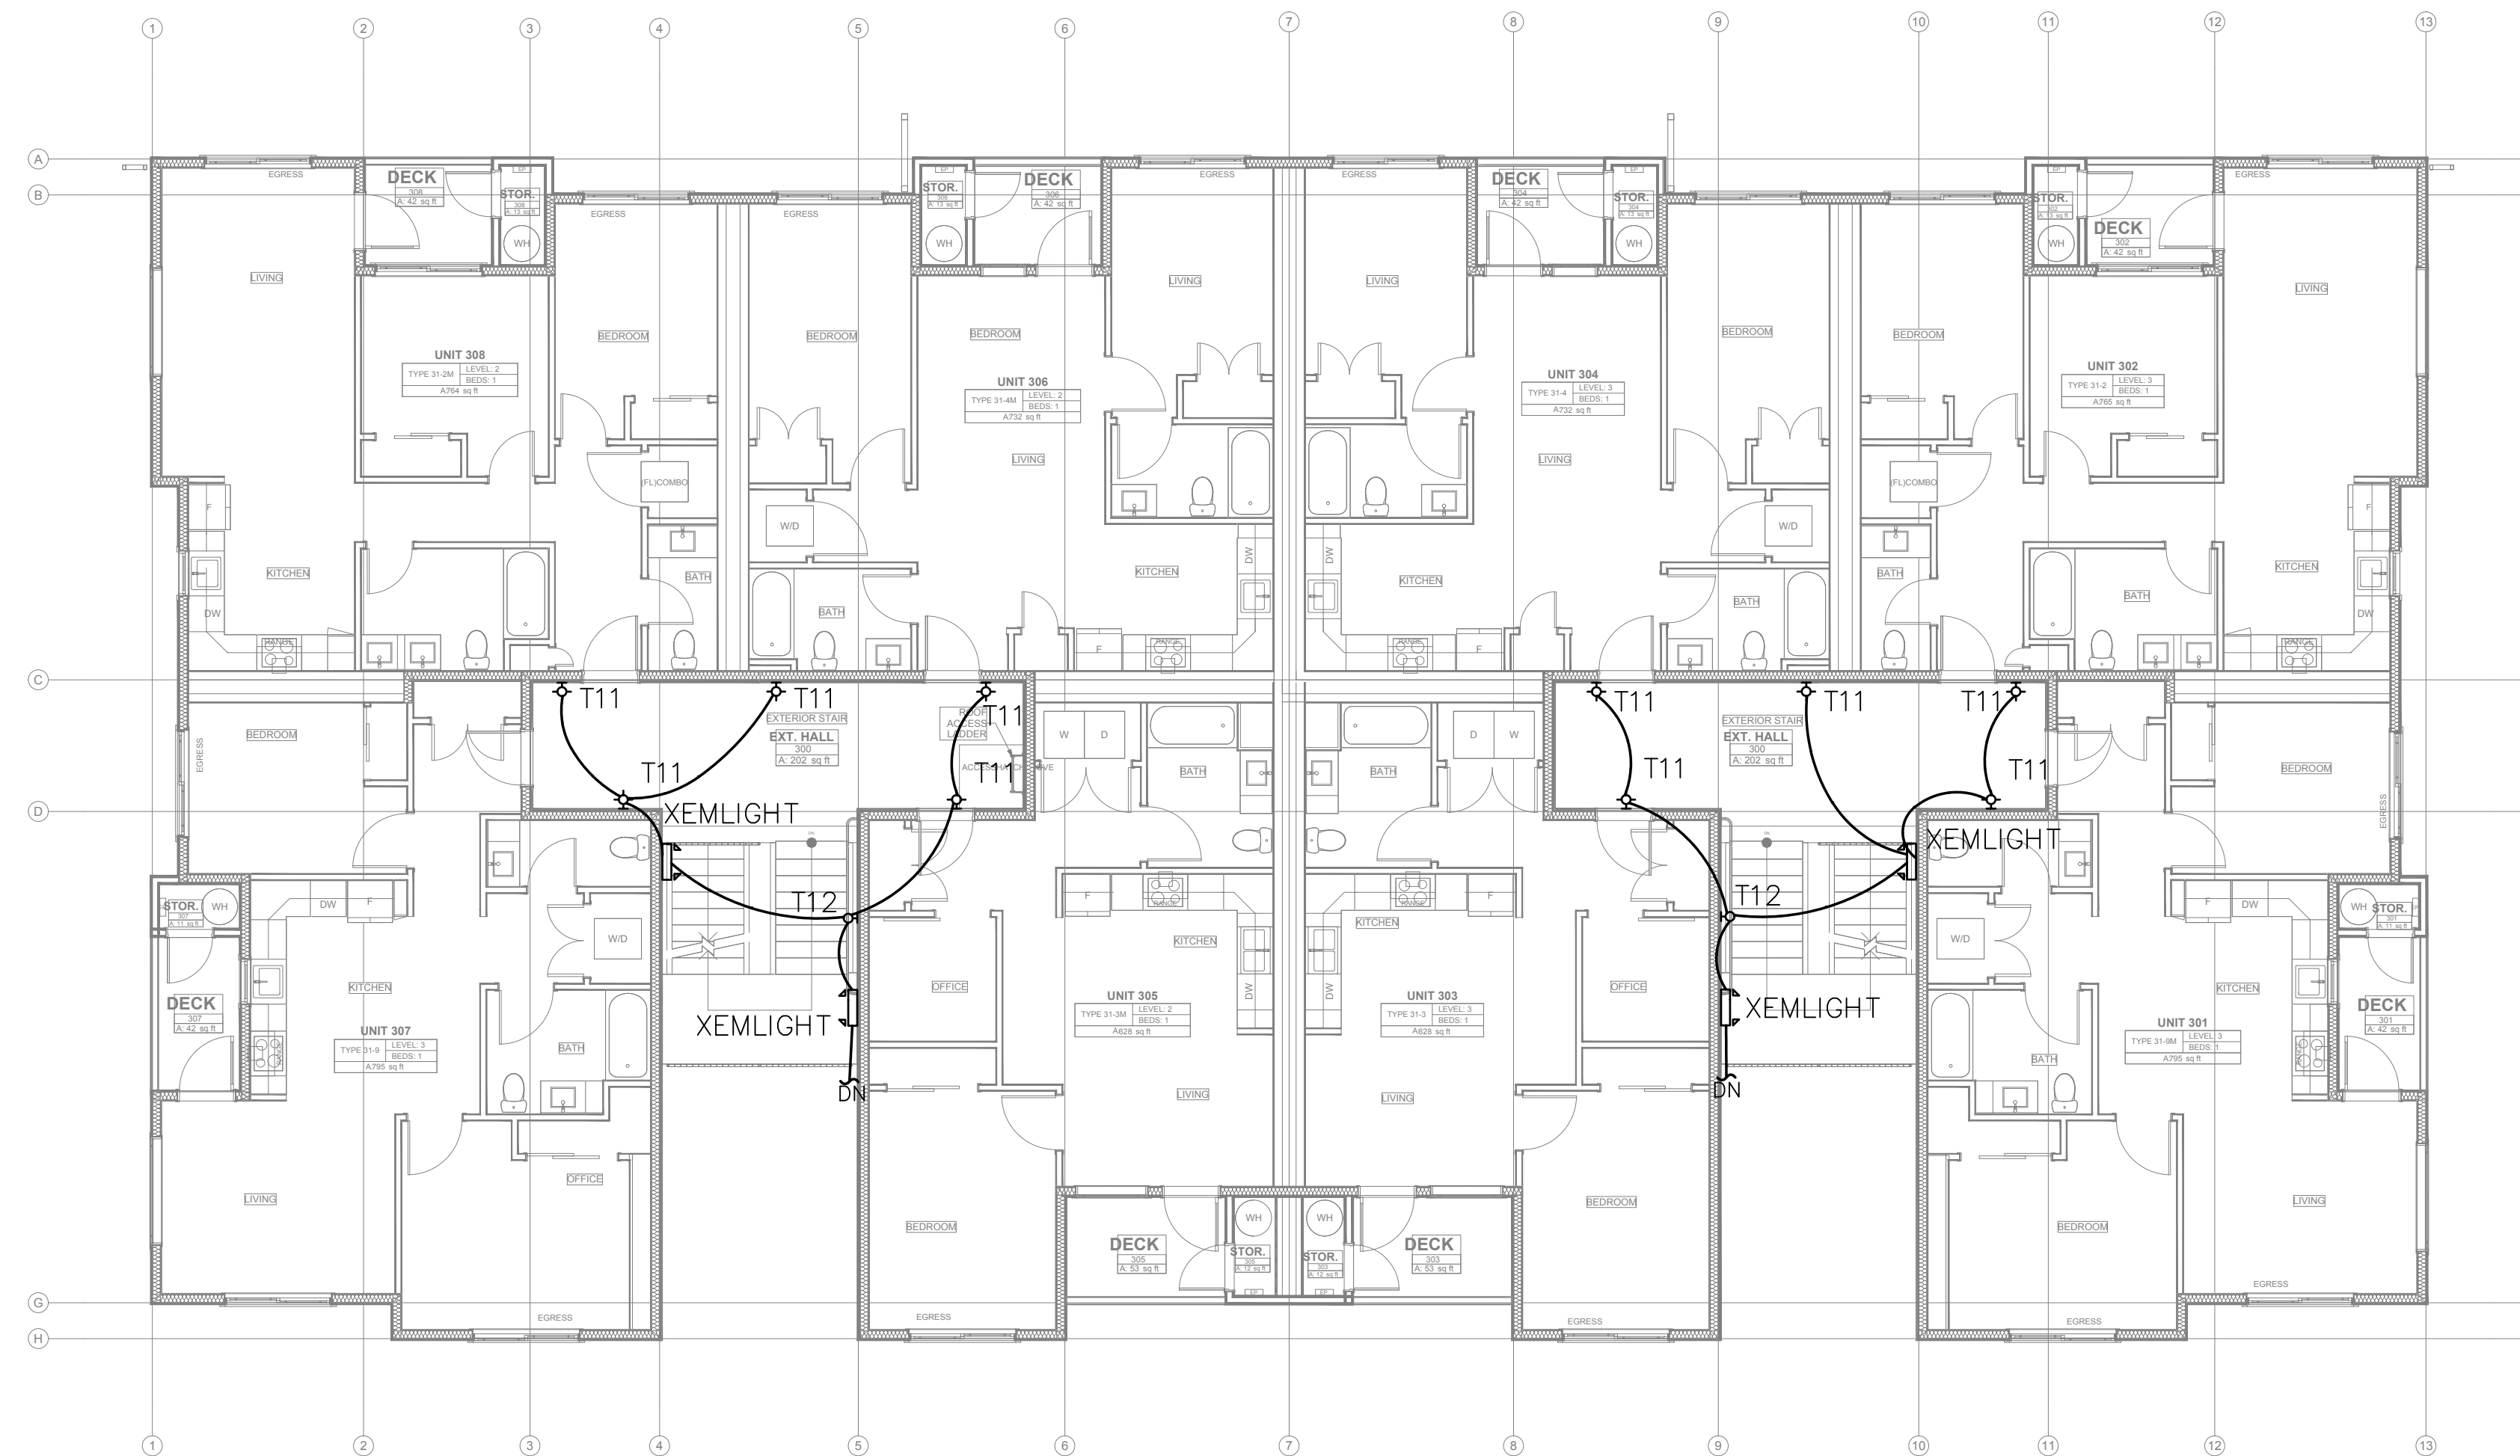

NO.	DATE	REVISIONS DESCRIPTION

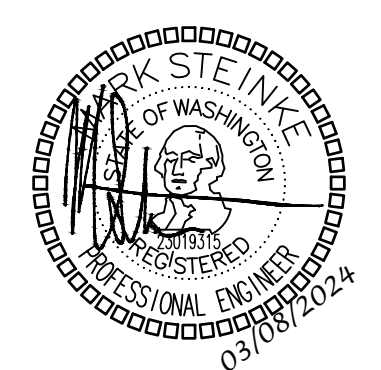

DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: **EAST TOWN CROSSING BUILDING F**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-836-1818

ROBISON ENGINEERING, INC


PERMIT SET
 03/08/2024

SHEET TITLE:
LIGHTING PLAN - LEVEL 3

SHEET NO.
 E1.03

LIGHTING PLAN — LEVEL 3

SCALE: 1/8" = 1'-0" 0' 4' 8' 16'




PHOTOMETRIC NOTES


1. PHOTOMETRIC CALCULATIONS BASED ON AVAILABLE IES FILE FROM FIXTURE MANUFACTURER (OR EQUIVALENT). FIXTURE SUBSTITUTIONS MAY COMPROMISE FOOT CANDLE LEVELS.
2. PHOTOMETRIC CALCULATIONS MEASURED AT GRADE LEVEL FROM CEILING HEIGHT OR MOUNTING HEIGHT (MH) NOTED IN LUMINAIRE SCHEDULE.
3. SITE PHOTOMETRIC: BASED ON PROPOSED SITE LIGHTING FOR PROJECT ONLY.

Egress Photometric Schedule

AVERAGE FOOT-CANDLES	1.73
MAXIMUM FOOT-CANDLES	4.2
MINIMUM FOOT-CANDLES	0.1
MINIMUM TO MAXIMUM FC RATIO	0.03

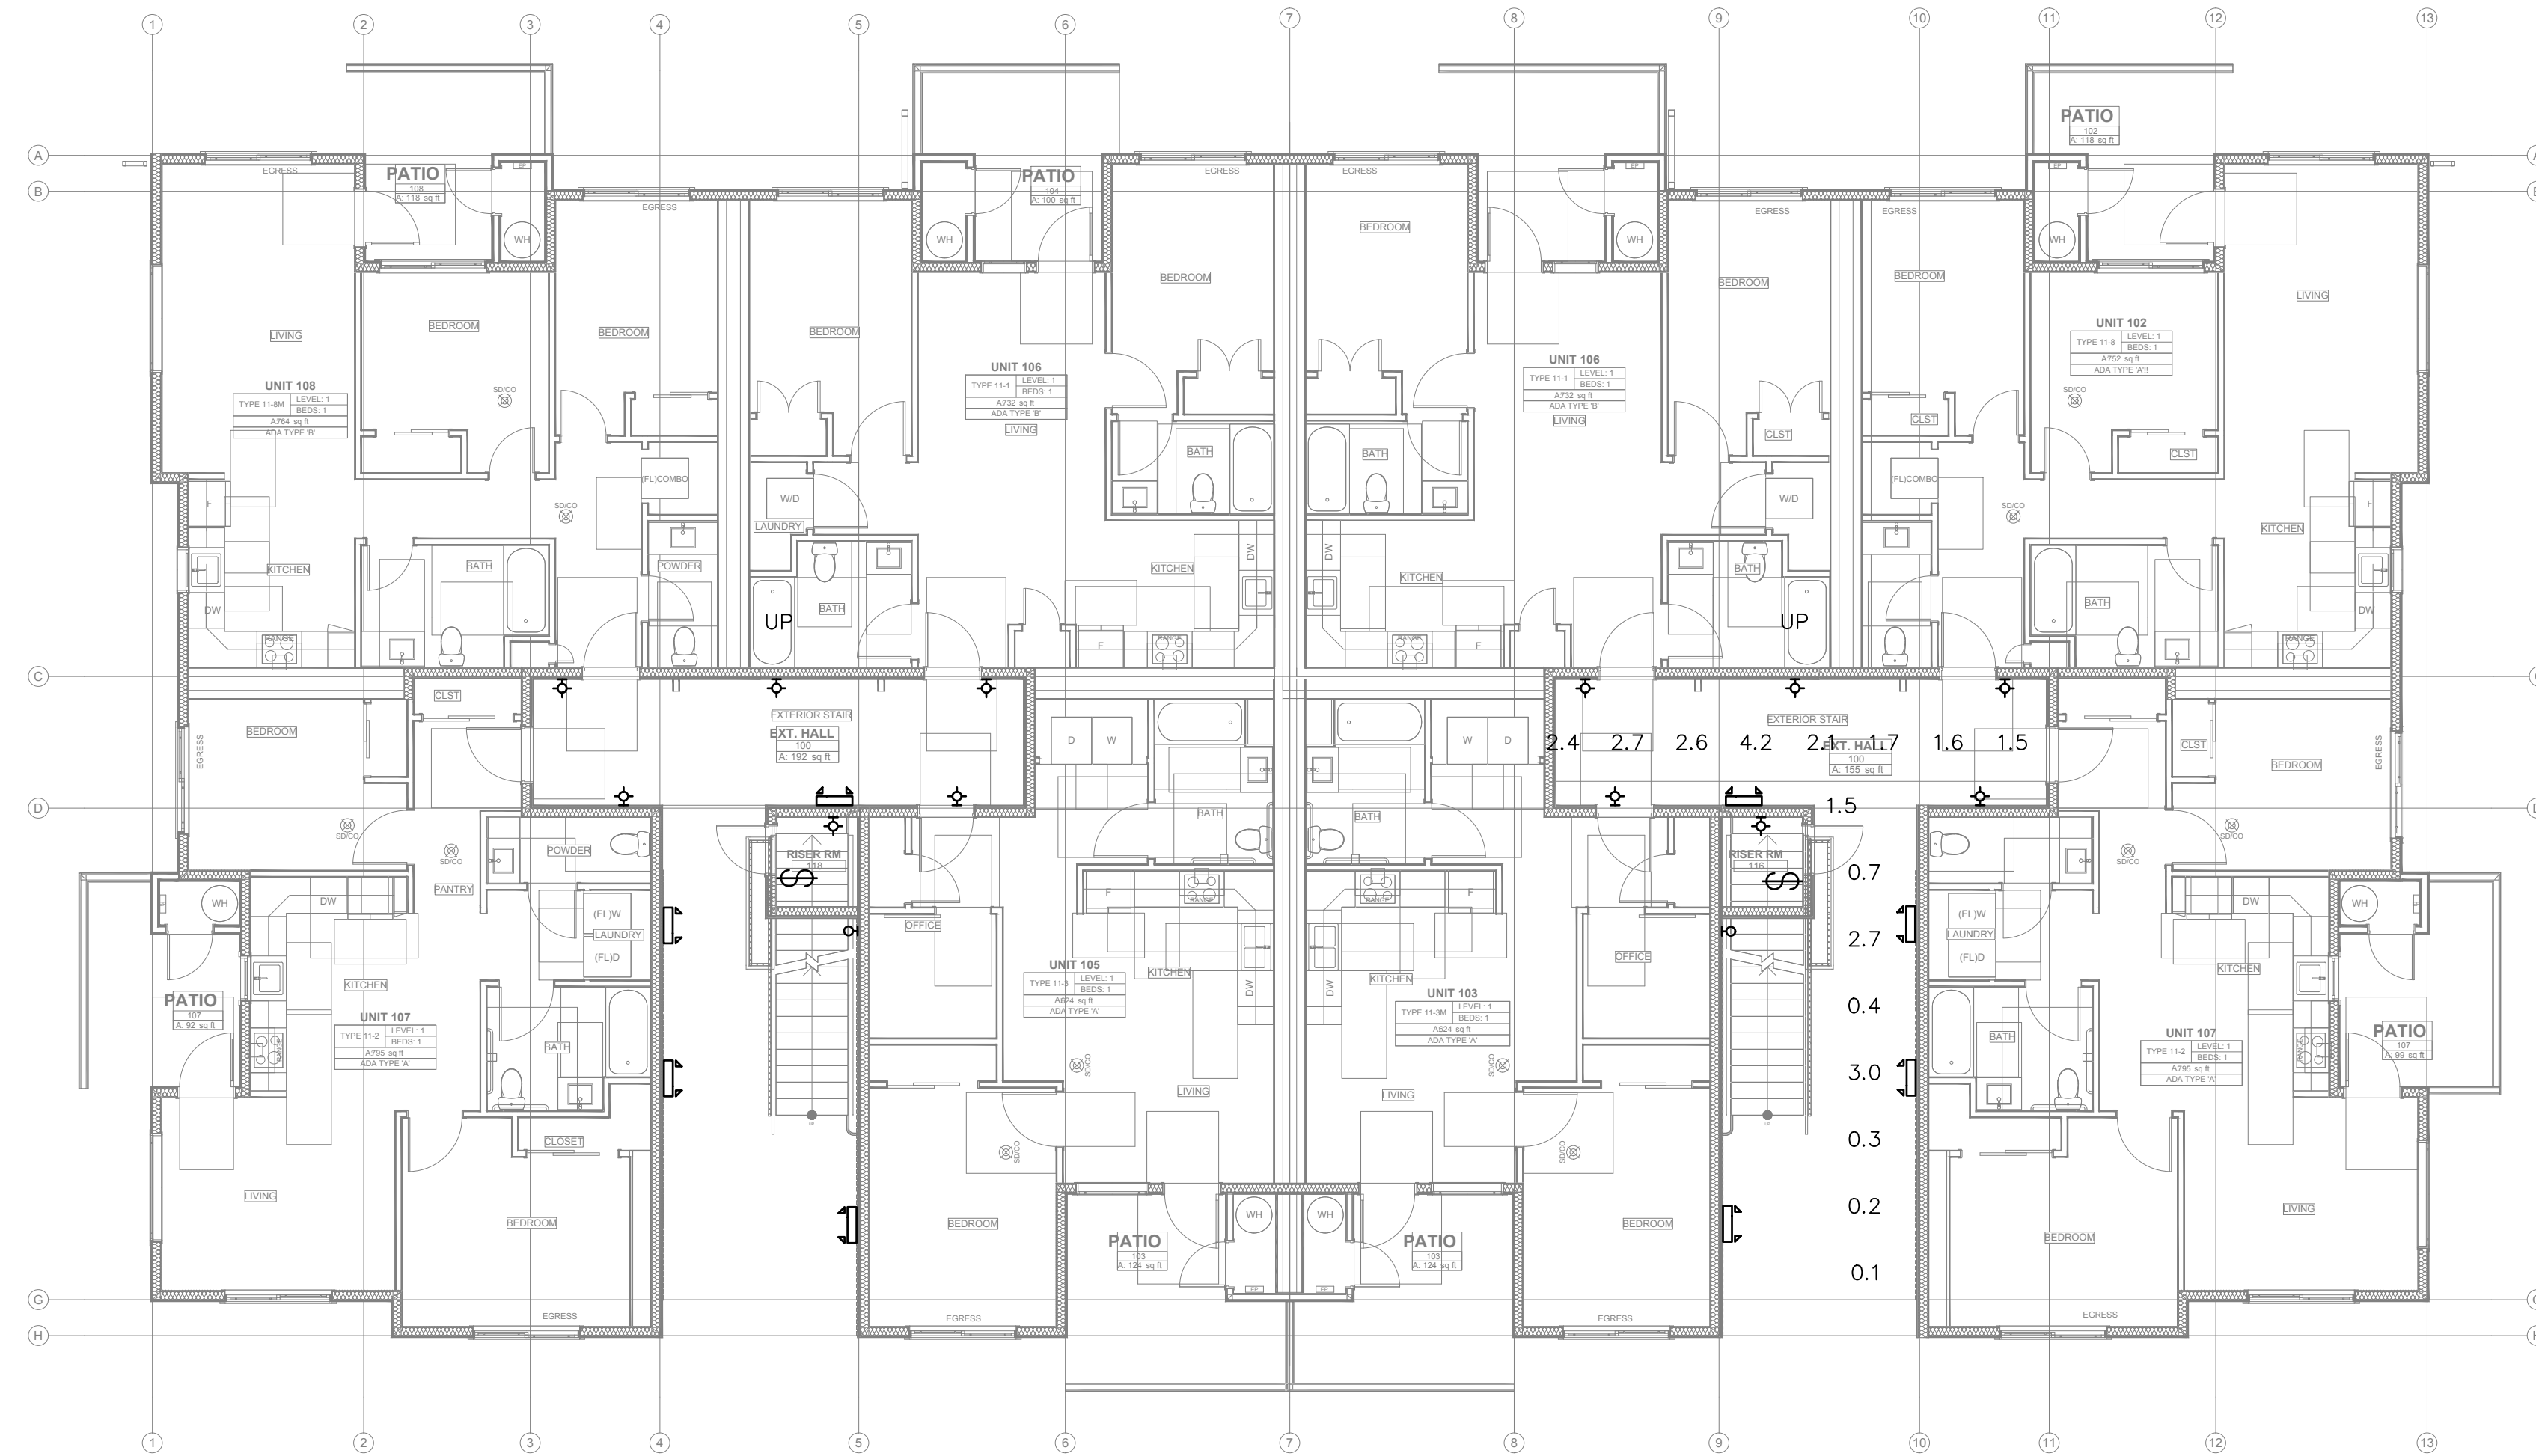

NO.	DATE	DESCRIPTION

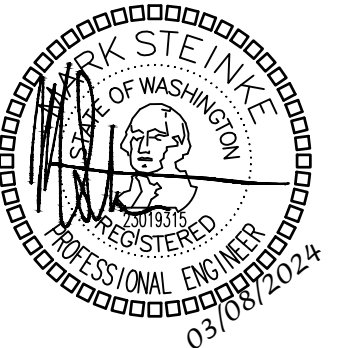

DRAWN: LYSAK K.	CHECKED: STEINKE M.
DESIGNED: LYSAK K.	APPROVED: STEINKE M.

PROJECT: **EAST TOWN CROSSING BUILDING F**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-845-8118

ROBISON ENGINEERING, INC.

PERMIT SET
 03/08/2024

SHEET TITLE:
PHOTOMETRIC PLAN - LEVEL 1

SHEET NO.
 E1.10

PHOTOMETRIC PLAN — LEVEL 1
 SCALE: 1/8" = 1'-0" 0' 4' 8' 16'



EXTERIOR & SITE LUMINAIRE SCHEDULE

CALLOUT	SYMBOL	MOUNTING	DESCRIPTION	MODEL	VOLTAGE	TYPE	CRI / CCT	LAMPING	WATTAGE
CP1	○	SURFACE	CARPORT LIGHT - TYPE 5 - B1 U0 G1	GARDCO: SVPG A01 830 5CD [MOUNTING] UNV	MULTIPLE	0-10V DIMMING	80 / 3000K	(1) 21W LED	21
SB1	○	3' BOLLARD	BOLLARD - TYPE 5 - B1 U0 G0	GARDCO: PUREFORM BOLLARD / PBL 36 14L 100 WW-G2 5 UNV	MULTIPLE	0-10V DIMMING	70 / 3000K	(1) 6W LED	6
SB1A	⊕	3' BOLLARD	BOLLARD - TYPE 3 - B0 U0 G0	GARDCO: PUREFORM BOLLARD / PBL 36 14L 100 WW-G2 3 UNV	MULTIPLE	0-10V DIMMING	70 / 3000K	(1) 6W LED	6
SF1	⊕	SURFACE	MONUMENT SIGN FLOOD LIGHT	TBD	120	TBD		(1) 15W LED	15
SP1	○	16' POLE	POST TOP LIGHT - TYPE 5 - B2 U3 G2	WE-EF: ZFT434LED / 115-1283	MULTIPLE	0-10V DIMMING	80 / 3000K	(1) 42W LED	42
SP2	○	16' POLE	POLE LIGHT - SPORT COURT - B1 U0 G2 - TYPE 3	SIGNIFY - GARDCO: P15 P A03 730 T3M AR1 UNV PCB [FINISH]	MULTIPLE	0-10V DIMMING	80 / 3000K	(1) 45W LED	45
SU1	⊕	TREE BAND	UPLIGHT - ACCENT	HK LIGHTING: ZXLI61 120V 5W 30K 010 / TMS120 TS - WATER TIGHT FITTING - CORD & PLUG BY ELECTRICAL	120	0-10V DIMMING		(1) 10W LED	10
SW1	⊕	SURFACE	EXTERIOR SCONCE - STAIRS - NB UP / TYPE II DOWN - MH 10'	PERFORMANCE IN LIGHTING: AMON / 070274	MULTIPLE	0-10V DIMMING	80 / 3000K	(1) 37W LED	37
SW2	⊕	SURFACE	SECURITY LIGHT - TRASH ENCLOSURES	STONCO: SL20 SCT G1 8 BK	MULTIPLE	INTEGRAL MOTION & PHOTOCCELL	70 / 3000K	(1) 20W LED	20
WP1	⊕	SURFACE	WALL PACK - PARKING - TYPE III - B2 U0 G2 - MH 18'	GARDCO: PUREFORM COMFORT OPTICS / PWS 140L 1150 WW-G2 3 X UNV	MULTIPLE	AS NEEDED	70 / 3000K	(1) 52W LED	52
WP2	⊕	SURFACE	WALL PACK - POOL - TYPE IV - B3 U0 G3 - MH 14'	GARDCO: PUREFORM COMFORT OPTICS / PWS 140L 1675 WW-G2 4 UNV	MULTIPLE	AS NEEDED		(1) 76W LED	76

- CONTRACTOR TO FURNISH AND INSTALL ALL FIXTURES.
- FIXTURE FINISHES TO BE COORDINATED WITH ARCHITECT/ID.

DWELLING UNIT LUMINAIRE SCHEDULE

CALLOUT	SYMBOL	LAMP	MOUNTING	DESCRIPTION	MODEL	VOLTAGE	WATTAGE	NOTES
T1	⊕	(1)	CEILING	SURFACE MOUNT LED LIGHT	OSTW: OW-LFMDR-14D2130-NK	120V 1P 2W	21	
T2	⊕	(1)	CEILING	SURFACE MOUNT LED	OSTW: OW-LDS01-6D1530N	120V 1P 2W	15	
T3	○	(1)	CEILING	FAN/LIGHT COMBO	KICHLER: 330017NI	120V 1P 2W	52	PROVIDE DIVA: DVFSQ-LF CONTROLLER IN UNITS DESIGNATED AS ACCESSIBLE PER ARCHITECTUAL
T4	⊕	(1)	PENDANT	LED CHANDELIER	OSTW: OW-LSFDR-12D1530-NK	120V 1P 2W	15	
T5	●	(1)	CEILING	LAUNDRY LIGHT/HOUSE FAN COMBO	BROAN: LP50100DC	120V 1P 2W	45	
T6	●	(1)	CEILING	BATH FAN/LIGHT COMBO	ORB: OSP70L	120V 1P 2W	45	
T7	⊕	(1)	WALL	LED VANITY LIGHT	KICHLER: 5337NIS	120V 1P 2W	27	(3) BULBRITE 9W LED BULBS: ITEM #774006
T8	⊕	(1)	WALL	EXT. LED SCONCE		120V 1P 2W	20	
T9	○	(1)	CEILING	SURFACE MOUNT LED	OSTW: OW-LDS0B-6D1830W	120V 1P 2W	18	
T13	□	(1)	CEILING	1.4 LED TROFFER	TBD	120V 1P 2W	40	

- CONTRACTOR TO FURNISH AND INSTALL ALL FIXTURES.
- FIXTURE FINISHES TO BE COORDINATED WITH ARCHITECT/ID.

GENERAL LIGHTING NOTES

- LIGHTING CONTROLS SHALL BE INSTALLED WHICH MEET ALL REQUIREMENTS OF LOCAL ENERGY CODES.
- EMERGENCY LIGHT FIXTURES: PROVIDE UNSWITCHED HOT FOR BATTERY CHARGER.
- LOCATIONS OF OCCUPANCY SENSORS, PHOTO SENSORS, DIMMERS, AND SWITCHES ARE DIAGRAMMATIC. CONTRACTOR TO FIELD-IDENTIFY OPTIMAL LOCATIONS AND QUANTITIES.
- ASSURE COMPATIBILITY OF DIMMERS WITH CONTROLLED LUMINAIRES PRIOR TO PURCHASING.
- AUTOMATIC LIGHTING SHUT-OFF CONTROLS SHALL BE PROVIDED BY LOCAL OCCUPANCY SENSORS AND/OR ASTRONOMIC TIME CLOCK UNLESS OTHERWISE NOTED.
- DAYLIGHT ZONES ARE REFERRED TO AS 'PRIMARY' AND 'SECONDARY' ON PLANS AND DENOTED BY DASHED LINES.
- FOR CUSTOM FF&E FIXTURES, IT IS THE MANUFACTURER'S RESPONSIBILITY TO FURNISH PRODUCTS WHICH ARE COMPLIANT WITH ALL REQUIREMENTS OF LOCAL ENERGY CODES, AS WELL AS MATCH THE ELECTRICAL SPECIFICATIONS PROVIDED IN THE LUMINAIRE SCHEDULES. PROVIDE SUBMITTAL SHOP DRAWINGS WITHIN 30 DAYS OF RECEIVING FIXTURE ORDER. SUBMITTALS SHALL CLEARLY INDICATE LAMPING AND MAXIMUM WATTAGE RATING OF LAMP SOCKETS. NON-COMPLIANT FIXTURES REJECTED BY ELECTRICAL INSPECTOR SHALL BE RETURNED TO THE MANUFACTURER FOR REWORKING AND/OR RE-LABELING.
- EMERGENCY EGRESS LIGHTING TO BE CONFIRMED AS INTENDED EGRESS DESIGN PRIOR TO PERMITTING

EXIT SIGN NOTES

DURING CONSTRUCTION, UPON COMPLETION OF A TYPICAL FLOOR FRAMING AND BEFORE WALL COVER, ELECTRICAL CONTRACTOR SHALL WALK THE EGRESS PATHS WITH THE LOCAL INSPECTOR (AHJ) TO CONFIRM THAT ALL THE EXIT SIGNS ARE LOCATED PER THE AHJ'S SATISFACTION AND IDENTIFY ANY ADDITIONAL EXIT SIGNS THAT THE AHJ WISHES TO BE INSTALLED. CONTRACTOR SHALL INCLUDE IN THEIR BASE BID UP TO 10% ADDITIONAL EXIT SIGNS (HIGH & LOW) AT NO ADDITIONAL COST. INCLUDE COST OF FIXTURES AND ASSOCIATED WIRING AND INSTALLATION.

LIGHTING CONTROL SYSTEM REQUIREMENTS

- CONTRACTOR TO PROVIDE A FULLY OPERATIONAL LIGHTING CONTROL SYSTEM.
- ELECTRICAL CONTRACTOR SHALL COORDINATE WITH A LIGHTING CONTROLS VENDOR TO OBTAIN LIGHTING CONTROL SYSTEM PACKAGE COMPLETE WITH DEVICES, WIRING DIAGRAMS, ANNOTATED PLANS INDICATING WHICH DEVICE TO BE USED IN EACH LOCATION, CONNECTION REQUIREMENTS, SET UP INSTRUCTIONS, COMMISSIONING AND CHECK-OUT FOLLOWING COMPLETION. PROVIDE ALL LOW VOLTAGE WIRING AS REQUIRED FOR CONTROL DEVICE INTERCONNECTIONS.
- INSTALLER QUALIFICATIONS: TECHNICIAN INSTALLING AND WIRING THE LIGHTING CONTROL SYSTEM SHALL HAVE INSTALLED THIS SAME SYSTEM AT LEAST ONCE PREVIOUSLY. TECHNICIAN SHALL HAVE RECEIVED TRAINING BY FACTORY REPRESENTATIVE ON THE SYSTEM BEING INSTALLED.
- PROVIDE LIGHTING CONTROL SYSTEM TO PERFORM THE FUNCTIONS DESCRIBED BELOW AND WHERE INDICATED ON PLANS. NOT ALL FEATURES ARE REQUIRED.
 - CONTROL EXTERIOR LIGHTING BASED ON ASTRONOMIC TIME-CLOCK SCHEDULING.
 - INTERIOR PRIMARY AND SECONDARY DAYLIGHT HARVESTING CONTROL PER ENERGY CODE REQUIREMENTS.
 - PROVIDE SEPARATE SWITCHING AND DIMMING CONTROL FOR LIGHTING ZONES AS INDICATED IN LIGHTING DIMMING SCHEDULE.
- DURING EMERGENCY CONDITIONS EMERGENCY LIGHTING CIRCUITS SHALL BYPASS ALL LIGHTING CONTROLS IN ORDER TO ENERGIZE ALL CONNECTED LUMINAIRES AT FULL CAPACITY. PROVIDE UL924 RELAYS AS REQUIRED TO BYPASS AREA CONTROLS.

LIGHTING CONTROLS LEGEND

⊕	TOGGLE SWITCH FOR MANUAL ON/OFF LIGHTING CONTROL. SUBSCRIPT INDICATES WHICH FIXTURES ARE TO BE CONTROLLED BY WHICH SWITCH.
⊕	DIMMER SWITCH FOR MANUAL MULTI-LEVEL LIGHTING CONTROL. SWITCH SHALL ALSO HAVE MANUAL ON/OFF FUNCTIONALITY. SUBSCRIPT INDICATES WHICH FIXTURES ARE TO BE CONTROLLED BY WHICH DIMMER.
OS OS	SWITCHES LABELED 'OS' SHALL TURN OFF ALL CONNECTED LUMINAIRES WITHIN 30 MINUTES OF SPACE BEING VACANT.
⊕	OCCUPANCY SENSOR SHALL AUTOMATICALLY TURN OFF ALL CONNECTED LUMINAIRES WITHIN 30 MINUTES OF SPACE BEING VACANT.
⊕	PHOTOSENSOR FOR DAYLIGHT ZONE CONTROL SHALL AUTOMATICALLY ADJUST THE LIGHT OUTPUT OF ALL CONNECTED LUMINAIRES BASED ON THE DAYLIGHT LEVEL IN THE SPACE.

NO.	DATE	DESCRIPTION



DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: **EAST TOWN CROSSING BUILDING F**
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206-864-3343

ROBISON ENGINEERING, INC.


PERMIT SET
03/08/2024

SHEET TITLE:
LIGHTING NOTES & LUMINAIRE SCHEDULE


SHEET NO.
E1.50


SHEET NOTES:

1. PROVIDE CONDUITS WITH PULL WIRE FROM DEMARCATION OR MDF TO IDF CLOSETS FOR ALL SYSTEMS INCLUDING VOICE, DATA, TV AND SECURITY. QUANTITY AND SIZE AS DETERMINED BY LOW VOLTAGE CONSULTANT. PROVIDE SLEEVES WITH BUSHINGS AT BOTH ENDS PER LOW VOLTAGE CONSULTANT. FIRE STOP AS REQUIRED BY AHJ
2. PROVIDE CONDUIT, WIRING, CIRCUITS AND CONNECTIONS AS COORDINATED WITH SECURITY VENDOR FOR FULLY FUNCTIONING SECURITY AND ACCESS CONTROL SYSTEM. COORDINATE WITH SECURITY CONSTRUCTION DOCUMENTS TO IDENTIFY ALL CAMERA LOCATIONS, AT ALL DOORS CALLED OUT BY OWNER, AS WELL AS ROLL UP GARAGE DOORS FOR GARAGE ACCESS.
3. AMENITY SPACES, OFFICES AND PUBLIC AREAS: ROUGH-IN FOR EQUIPMENT, OUTLETS AND APPLIANCES IN AMENITY SPACES TO BE COORDINATED WITH ARCHITECT. REFER TO ARCHITECTS DRAWINGS AND ELEVATIONS.
4. WIRING METHOD FOR APARTMENT FEEDERS MUST BE SUITABLE FOR THE TYPE OF CONSTRUCTION. SEE NEC 334.10
5. CONTRACTOR TO COORDINATE DOOR CONTROLS AND CONNECTIONS WITH DOOR VENDOR. PROVIDE RACEWAY, CONDUCTORS, POWER SUPPLY AND TERMINATIONS FOR A FULLY FUNCTIONING SYSTEM. COORDINATE WITH SECURITY VENDOR FOR MONITORING AND CONTROL AS NEEDED.
6. ELECTRICAL CONTRACTOR (EC) TO PROVIDE J-BOX/PULL BOX SO NUMBER OF BENDS IN CONDUIT DOES NOT EXCEED CODE REQUIREMENT (360 MAX TOTAL). EC TO FIELD VERIFY LOCATION OF J-BOX/PULL BOX. COORDINATE WITH ARCHITECT WHERE ACCESS PANEL IS REQUIRED.
7. PROVIDE BLOCKOUTS AND SLEEVES AS REQUIRED FOR ALL FEEDERS AND RISERS SHOWN ON 1-LINE. COORDINATE WITH STRUCTURAL. PROVIDE SUPPORT FOR VERTICAL FEEDERS AS REQUIRED BY NEC 300.19. ANY SLEEVE LOCATIONS SHOWN ARE DIAGRAMMATIC ONLY. ELECTRICAL PLANS DO NOT SHOW BRANCH CIRCUIT OR SMALL FEEDER CONDUIT RUNS. LAYOUT PER EC. FINAL VERIFICATION OF NUMBER AND LOCATION OF ALL FLOOR PENETRATIONS BY EC.

FLAG NOTES:  (NOT EVERY FLAG IS USED ON EVERY SHEET)

1. PROVIDE LOCKING COVER FOR EXTERIOR & CORRIDOR RECEPTACLES. TYP.
2. LEAVE 2" OF OPEN WALL SPACE ADJACENT TO HOUSE PANEL FOR FUTURE EV PANEL.
3. PROVIDE (1) 2" CONDUIT FROM TELEPHONE VAULT AND (1) 2" CONDUIT FROM THE CABLE TV VAULT. COORDINATE WITH TELECOM UTILITY FOR TELEPHONE & CABLE TV VAULT LOCATIONS.

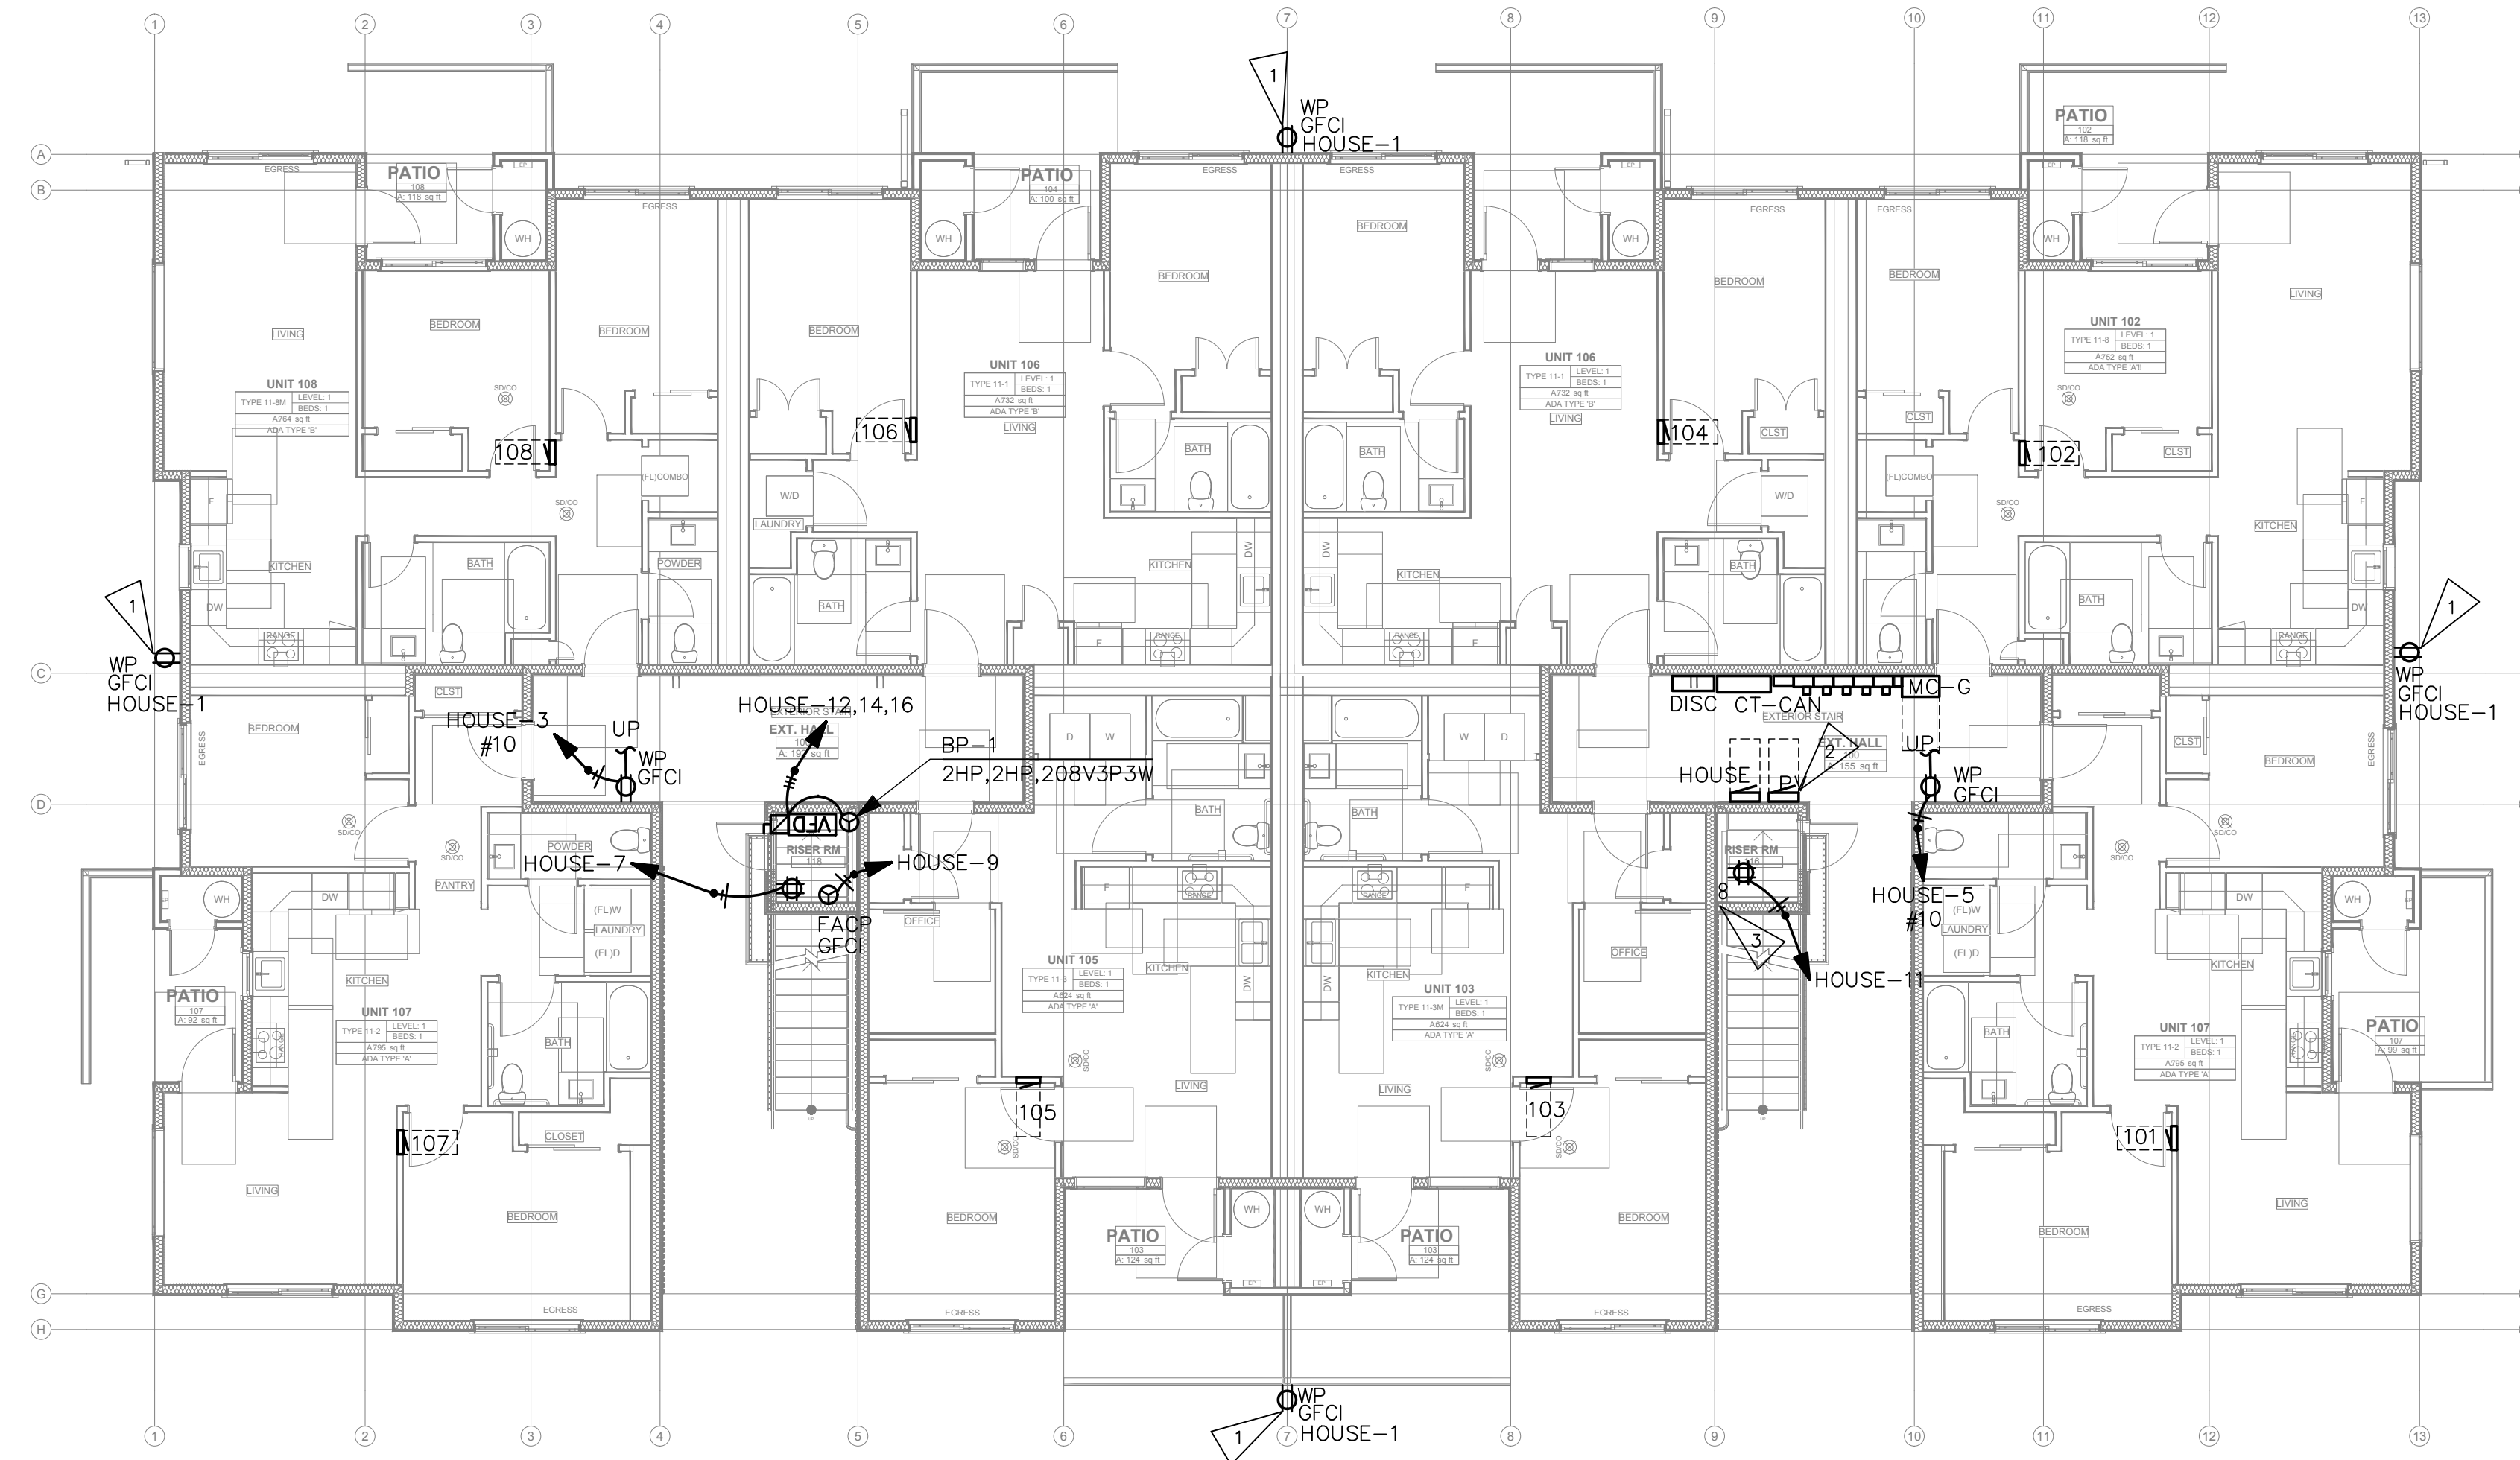

 TBD LOCATION

NO.	DATE	DESCRIPTION



DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: **EAST TOWN CROSSING BUILDING F**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA



19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-845-1818


ROBISON ENGINEERING, INC

PERMIT SET
 03/08/2024

SHEET TITLE:
POWER PLAN
 - LEVEL 1

SHEET NO.
 E3.00

POWER PLAN - LEVEL 1 
 SCALE: 1/8" = 1'-0" 

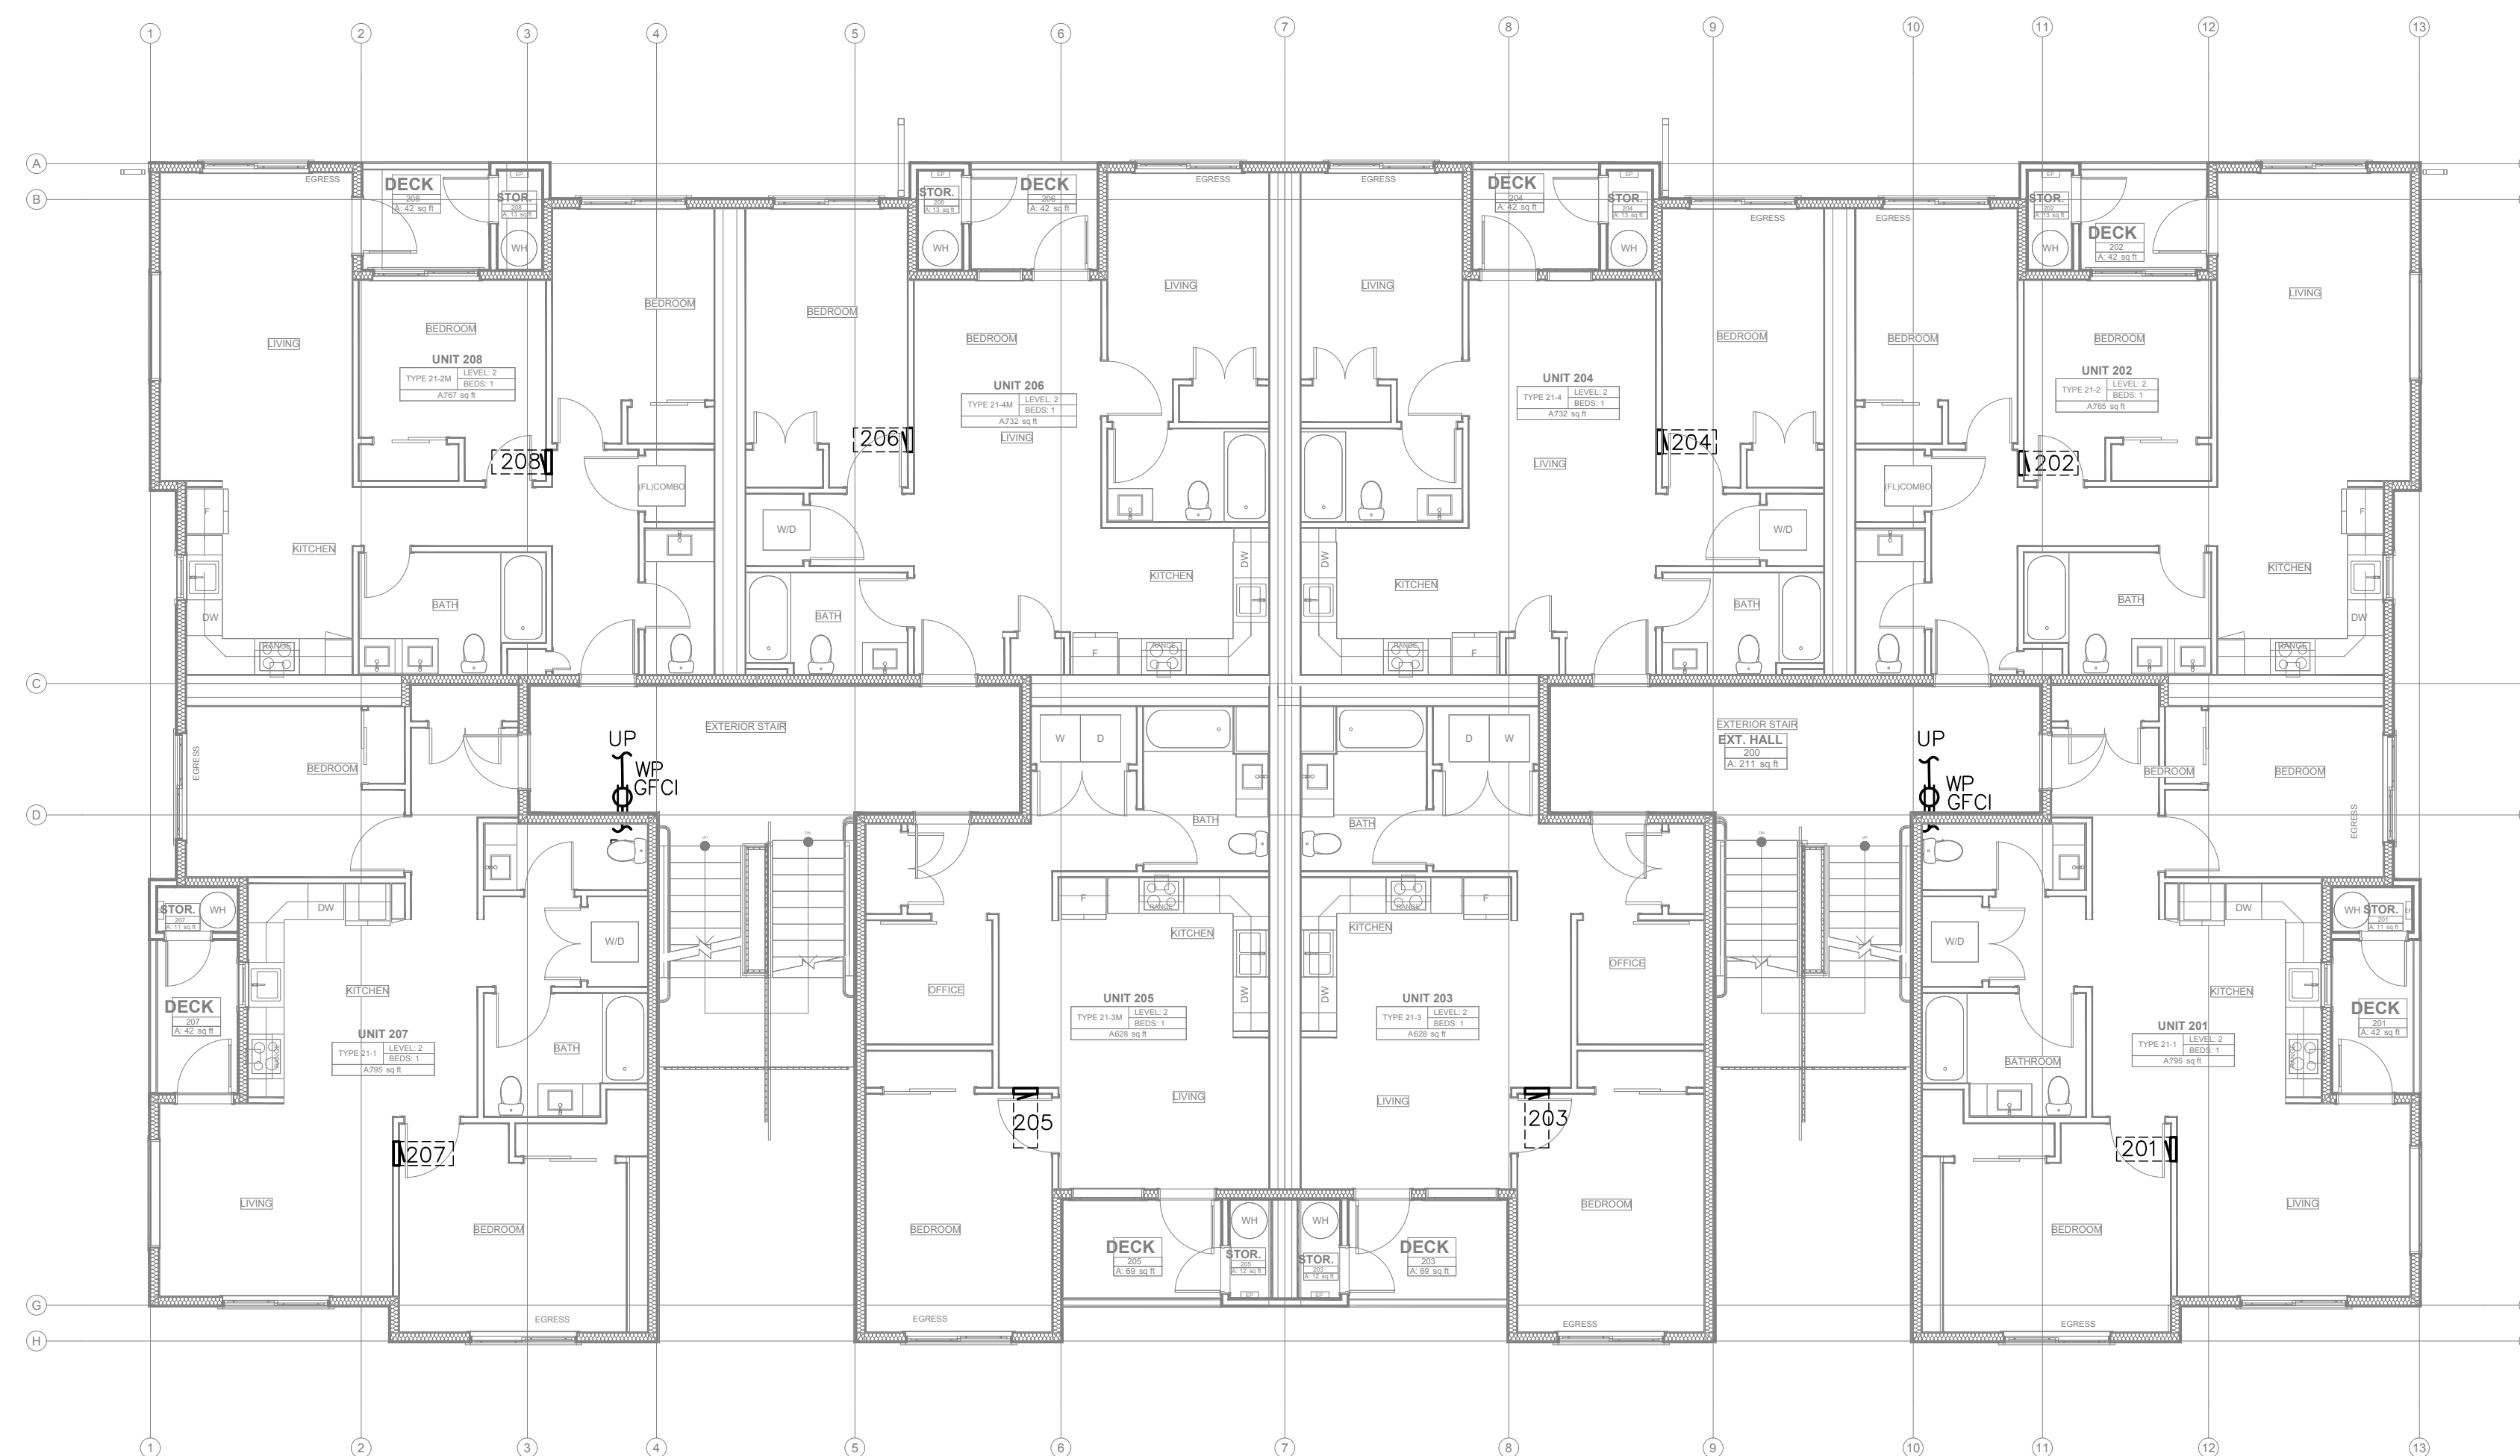

SHEET NOTES:

1. PROVIDE CONDUITS WITH PULL WIRE FROM DEMARCATION OR MDF TO IDF CLOSETS FOR ALL SYSTEMS INCLUDING VOICE, DATA, TV AND SECURITY. QUANTITY AND SIZE AS DETERMINED BY LOW VOLTAGE CONSULTANT. PROVIDE SLEEVES WITH BUSHINGS AT BOTH ENDS PER LOW VOLTAGE CONSULTANT. FIRE STOP AS REQUIRED BY AHJ
2. PROVIDE CONDUIT, WIRING, CIRCUITS AND CONNECTIONS AS COORDINATED WITH SECURITY VENDOR FOR FULLY FUNCTIONING SECURITY AND ACCESS CONTROL SYSTEM. COORDINATE WITH SECURITY CONSTRUCTION DOCUMENTS TO IDENTIFY ALL CAMERA LOCATIONS, AT ALL DOORS CALLED OUT BY OWNER, AS WELL AS ROLL UP GARAGE DOORS FOR GARAGE ACCESS.
3. AMENITY SPACES, OFFICES AND PUBLIC AREAS: ROUGH-IN FOR EQUIPMENT, OUTLETS AND APPLIANCES IN AMENITY SPACES TO BE COORDINATED WITH ARCHITECT. REFER TO ARCHITECTS DRAWINGS AND ELEVATIONS.
4. WIRING METHOD FOR APARTMENT FEEDERS MUST BE SUITABLE FOR THE TYPE OF CONSTRUCTION. SEE NEC 334.10
5. CONTRACTOR TO COORDINATE DOOR CONTROLS AND CONNECTIONS WITH DOOR VENDOR. PROVIDE RACEWAY, CONDUCTORS, POWER SUPPLY AND TERMINATIONS FOR A FULLY FUNCTIONING SYSTEM. COORDINATE WITH SECURITY VENDOR FOR MONITORING AND CONTROL AS NEEDED.
6. ELECTRICAL CONTRACTOR (EC) TO PROVIDE J-BOX/PULL BOX SO NUMBER OF BENDS IN CONDUIT DOES NOT EXCEED CODE REQUIREMENT (360 MAX TOTAL). EC TO FIELD VERIFY LOCATION OF J-BOX/PULL BOX. COORDINATE WITH ARCHITECT WHERE ACCESS PANEL IS REQUIRED.
7. PROVIDE BLOCKOUTS AND SLEEVES AS REQUIRED FOR ALL FEEDERS AND RISERS SHOWN ON 1-LINE. COORDINATE WITH STRUCTURAL. PROVIDE SUPPORT FOR VERTICAL FEEDERS AS REQUIRED BY NEC 300.19. ANY SLEEVE LOCATIONS SHOWN ARE DIAGRAMMATIC ONLY. ELECTRICAL PLANS DO NOT SHOW BRANCH CIRCUIT OR SMALL FEEDER CONDUIT RUNS. LAYOUT PER EC. FINAL VERIFICATION OF NUMBER AND LOCATION OF ALL FLOOR PENETRATIONS BY EC.

FLAG NOTES: (NOT EVERY FLAG IS USED ON EVERY SHEET)


1. PROVIDE LOCKING COVER FOR EXTERIOR & CORRIDOR RECEPTACLES. TYP.
2. LEAVE 2" OF OPEN WALL SPACE ADJACENT TO HOUSE PANEL FOR FUTURE EV PANEL.
3. PROVIDE (1) 2" CONDUIT FROM TELEPHONE VAULT AND (1) 2" CONDUIT FROM THE CABLE TV VAULT. COORDINATE WITH TELECOM UTILITY FOR TELEPHONE & CABLE TV VAULT LOCATIONS.

POWER PLAN - LEVEL 2

SCALE: 1/8" = 1'-0"



NO.	DATE	DESCRIPTION

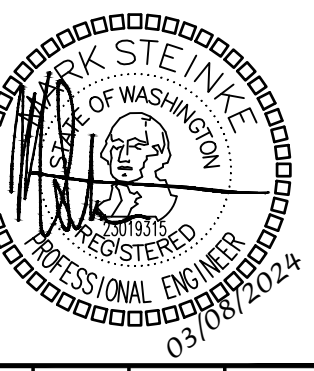

DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: EAST TOWN CROSSING BUILDING F
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206-834-5161



PERMIT SET
03/08/2024

SHEET TITLE:
**POWER PLAN
- LEVEL 2**

SHEET NO.
E3.01

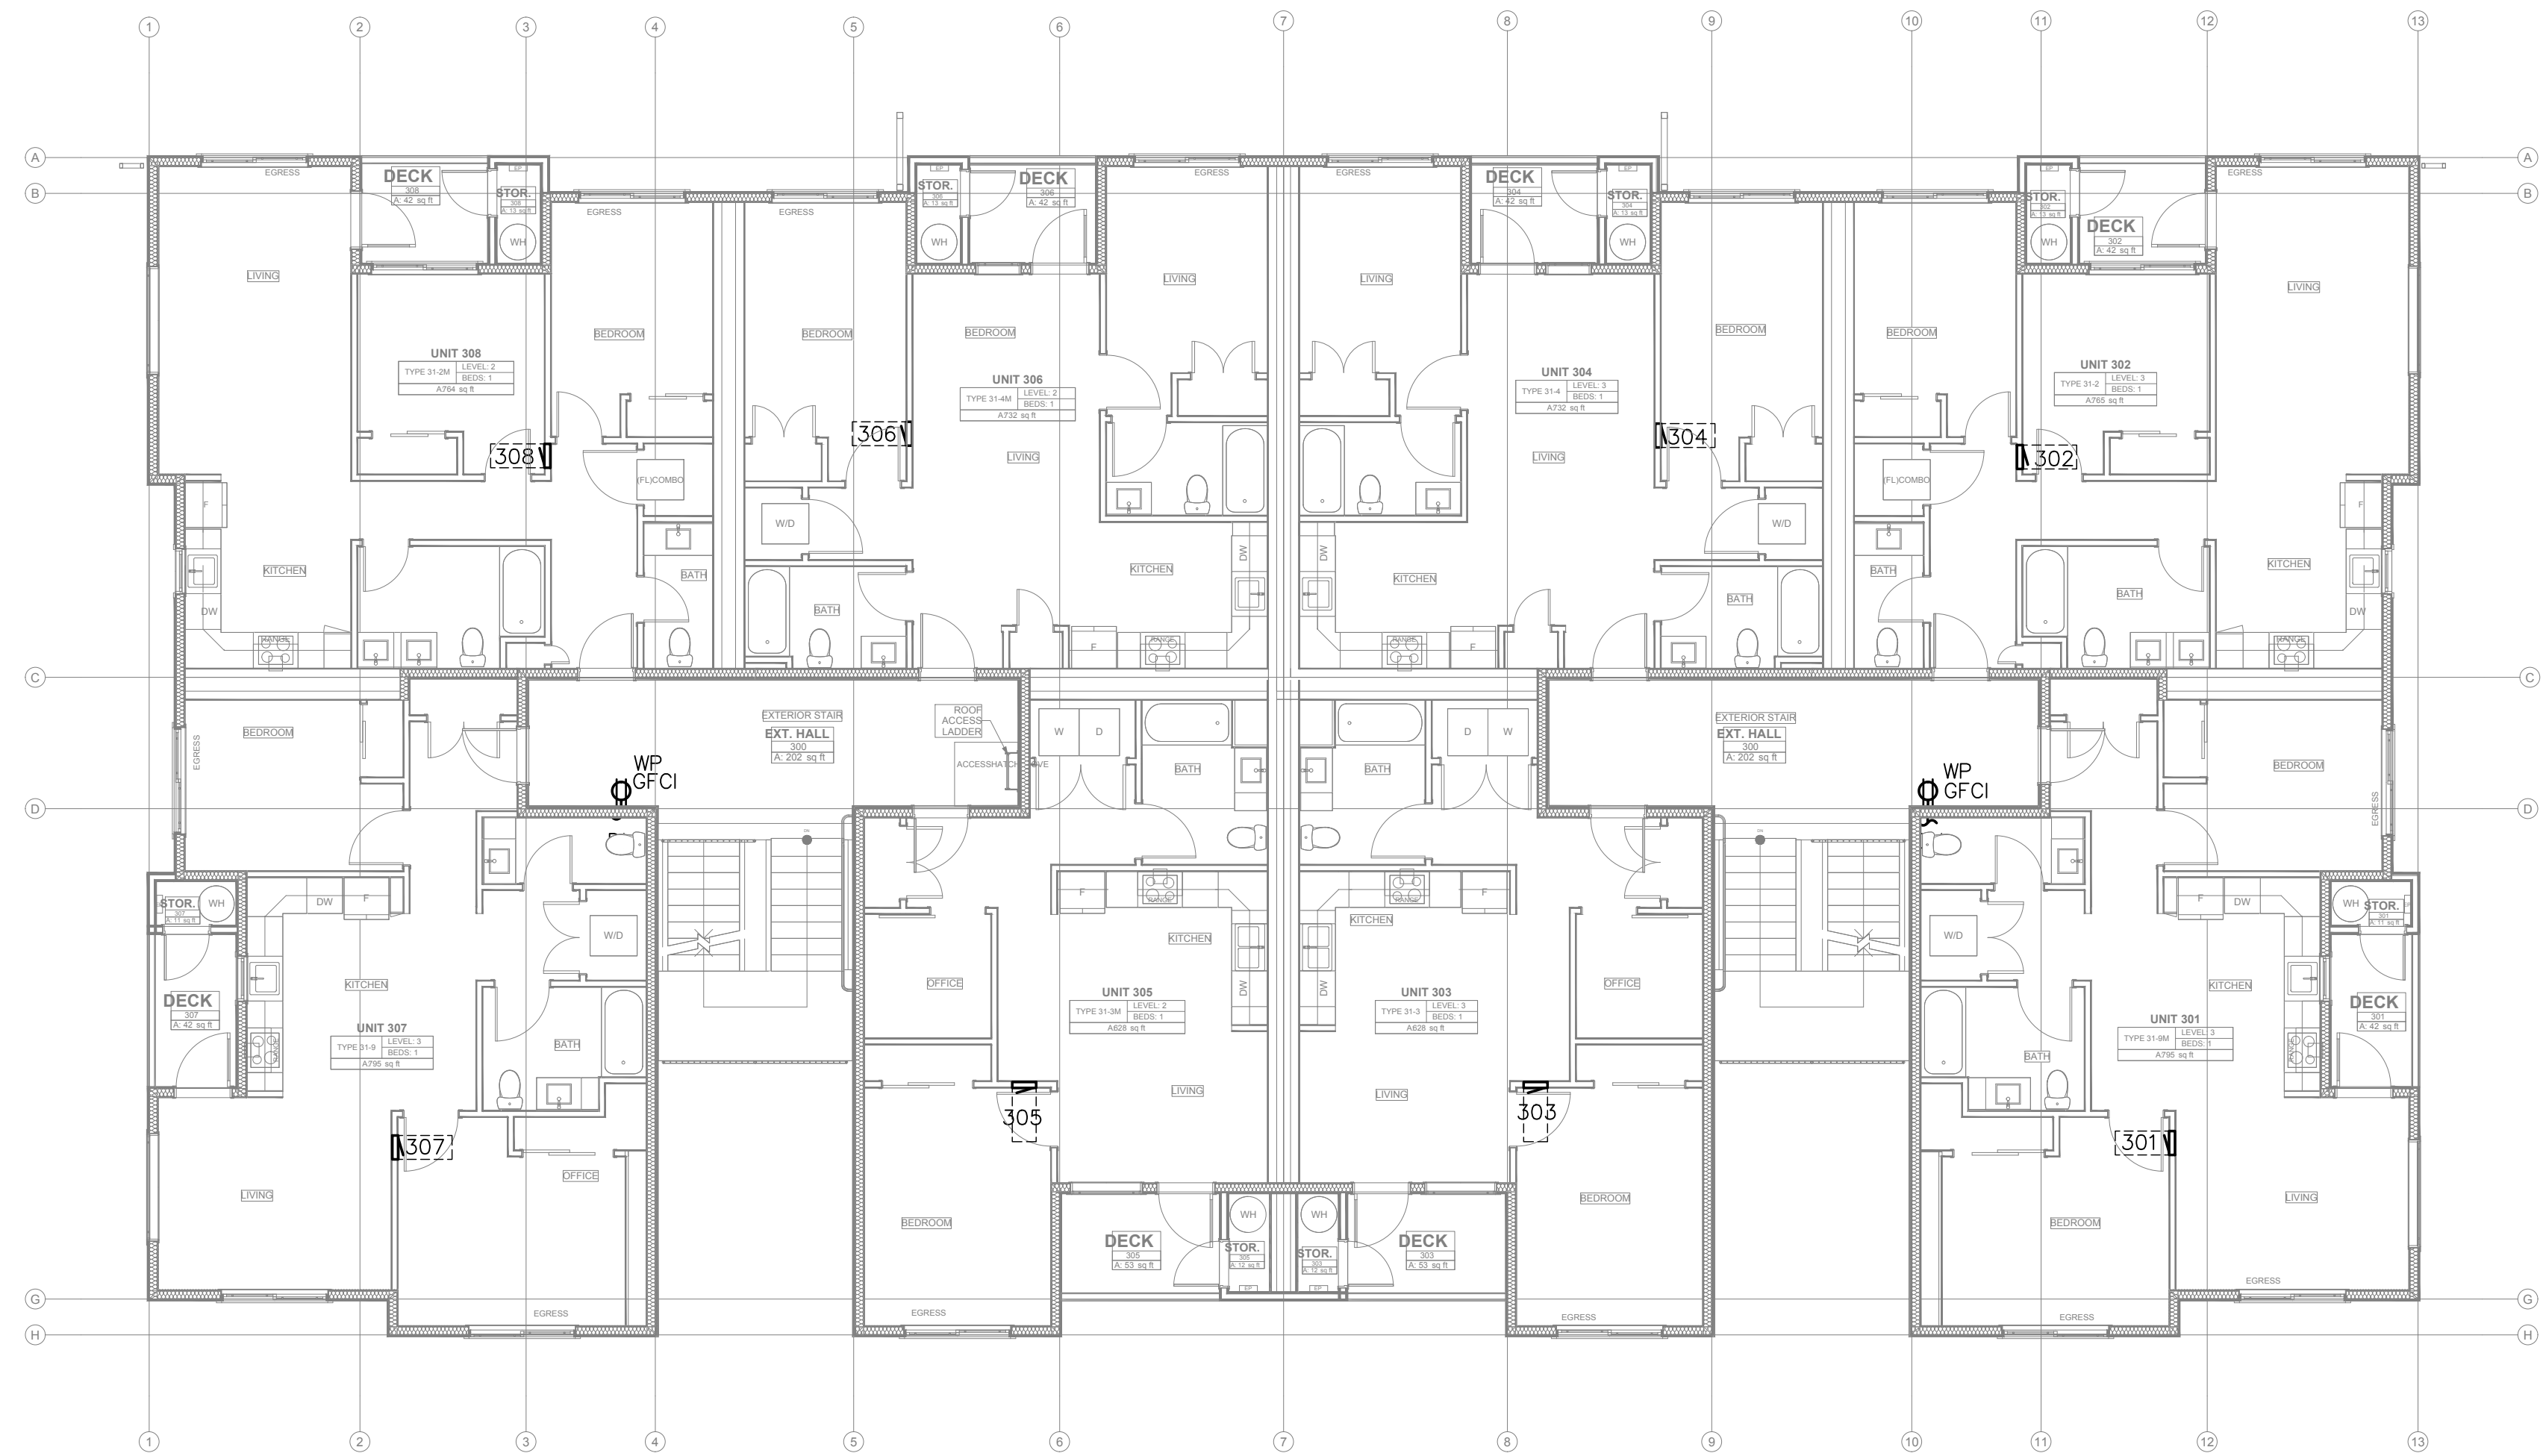


SHEET NOTES:

1. PROVIDE CONDUITS WITH PULL WIRE FROM DEMARCATION OR MDF TO IDF CLOSETS FOR ALL SYSTEMS INCLUDING VOICE, DATA, TV AND SECURITY. QUANTITY AND SIZE AS DETERMINED BY LOW VOLTAGE CONSULTANT. PROVIDE SLEEVES WITH BUSHINGS AT BOTH ENDS PER LOW VOLTAGE CONSULTANT. FIRE STOP AS REQUIRED BY AHJ
2. PROVIDE CONDUIT, WIRING, CIRCUITS AND CONNECTIONS AS COORDINATED WITH SECURITY VENDOR FOR FULLY FUNCTIONING SECURITY AND ACCESS CONTROL SYSTEM. COORDINATE WITH SECURITY CONSTRUCTION DOCUMENTS TO IDENTIFY ALL CAMERA LOCATIONS, AT ALL DOORS CALLED OUT BY OWNER, AS WELL AS ROLL UP GARAGE DOORS FOR GARAGE ACCESS.
3. AMENITY SPACES, OFFICES AND PUBLIC AREAS: ROUGH-IN FOR EQUIPMENT, OUTLETS AND APPLIANCES IN AMENITY SPACES TO BE COORDINATED WITH ARCHITECT. REFER TO ARCHITECTS DRAWINGS AND ELEVATIONS.
4. WIRING METHOD FOR APARTMENT FEEDERS MUST BE SUITABLE FOR THE TYPE OF CONSTRUCTION. SEE NEC 334.10
5. CONTRACTOR TO COORDINATE DOOR CONTROLS AND CONNECTIONS WITH DOOR VENDOR. PROVIDE RACEWAY, CONDUCTORS, POWER SUPPLY AND TERMINATIONS FOR A FULLY FUNCTIONING SYSTEM. COORDINATE WITH SECURITY VENDOR FOR MONITORING AND CONTROL AS NEEDED.
6. ELECTRICAL CONTRACTOR (EC) TO PROVIDE J-BOX/PULL BOX SO NUMBER OF BENDS IN CONDUIT DOES NOT EXCEED CODE REQUIREMENT (360 MAX TOTAL). EC TO FIELD VERIFY LOCATION OF J-BOX/PULL BOX. COORDINATE WITH ARCHITECT WHERE ACCESS PANEL IS REQUIRED.
7. PROVIDE BLOCKOUTS AND SLEEVES AS REQUIRED FOR ALL FEEDERS AND RISERS SHOWN ON 1-LINE. COORDINATE WITH STRUCTURAL. PROVIDE SUPPORT FOR VERTICAL FEEDERS AS REQUIRED BY NEC 300.19. ANY SLEEVE LOCATIONS SHOWN ARE DIAGRAMMATIC ONLY. ELECTRICAL PLANS DO NOT SHOW BRANCH CIRCUIT OR SMALL FEEDER CONDUIT RUNS. LAYOUT PER EC. FINAL VERIFICATION OF NUMBER AND LOCATION OF ALL FLOOR PENETRATIONS BY EC.

FLAG NOTES: (NOT EVERY FLAG IS USED ON EVERY SHEET)

1. PROVIDE LOCKING COVER FOR EXTERIOR & CORRIDOR RECEPTACLES. TYP.
2. LEAVE 2" OF OPEN WALL SPACE ADJACENT TO HOUSE PANEL FOR FUTURE EV PANEL.
3. PROVIDE (1) 2" CONDUIT FROM TELEPHONE VAULT AND (1) 2" CONDUIT FROM THE CABLE TV VAULT. COORDINATE WITH TELECOM UTILITY FOR TELEPHONE & CABLE TV VAULT LOCATIONS.

NO.	DATE	DESCRIPTION

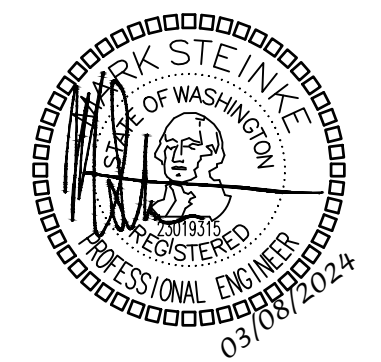

DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: **EAST TOWN CROSSING BUILDING F**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W. SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 964-3343


PERMIT SET
 03/08/2024

SHEET TITLE:
POWER PLAN
 - LEVEL 3

SHEET NO.
 E3.02

POWER PLAN - LEVEL 3


SCALE: 1/8" = 1'-0"

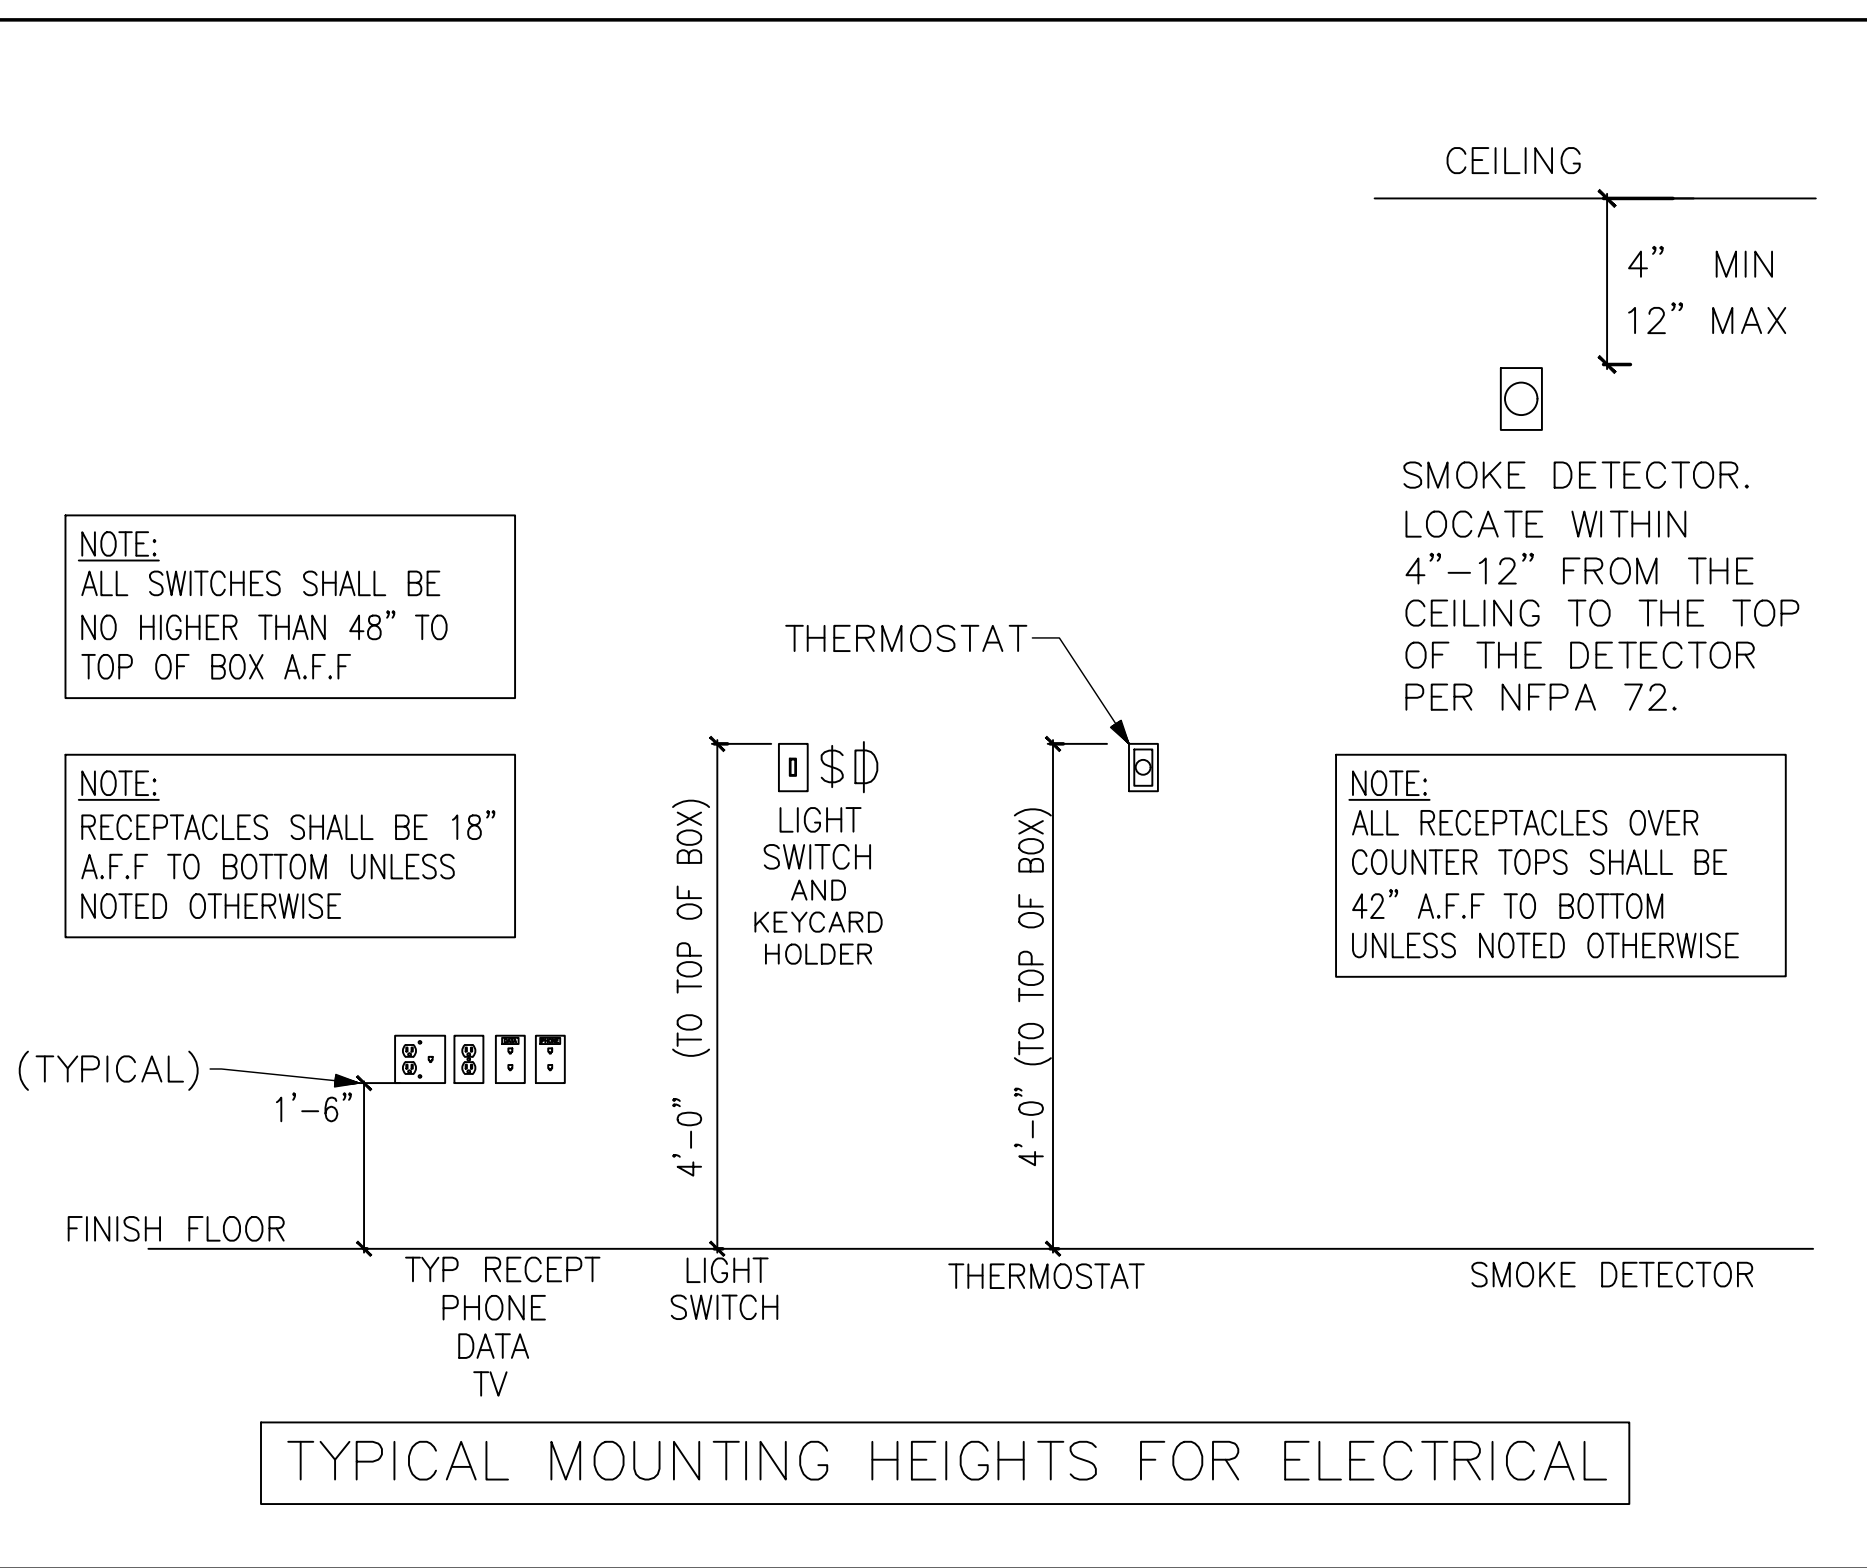

APARTMENT ELECTRICAL DEVICE SCHEDULE

SYMBOL	DEVICE	NOTES
⊕	RECEPTACLE, SIMPLEX	PROVIDE WHERE INDICATED.
⊕	RECEPTACLE, SIMPLEX, FLOOR MOUNT	PROVIDE WHERE INDICATED.
⊕	RECEPTACLE, DUPLEX, FLOOR MOUNT	PROVIDE WHERE INDICATED.
⊕	RECEPTACLE, DUPLEX	PROVIDE WHERE INDICATED.
⊕	RECEPTACLE, DUPLEX, SPLIT-WIRED	PROVIDE WHERE INDICATED. LOWER OUTLET CONTROLLED BY WALL SWITCH
⊕	RECEPTACLE, QUAD + TELEVISION CABLE OUTLET	PROVIDE WHERE INDICATED.
⊕	RECEPTACLE, QUAD	PROVIDE WHERE INDICATED.
▽	TELEPHONE WALL OUTLET	REFER TO LOW VOLTAGE PLANS
▽	COMM/DATA WALL OUTLET	REFER TO LOW VOLTAGE PLANS
⊕	TELEVISION CABLE OUTLET	REFER TO LOW VOLTAGE PLANS
\$	WALL SWITCH	PROVIDE WHERE INDICATED.
\$vs	WALL SWITCH VACANCY SENSOR	PROVIDE WHERE INDICATED.
\$SW	WALL SWITCH (3-WAY)	PROVIDE WHERE INDICATED.
⊕	WALL SWITCH DIMMER	PROVIDE WHERE INDICATED.
⊕	FAN CONTROL	PROVIDE WHERE INDICATED.
\$AT	SWITCH ASTRONOMICAL TIME CLOCK CONTROL	PROVIDE WHERE INDICATED.
⊕	LIGHT FIXTURE, WALL MOUNTED SCNCE	PROVIDE ROUGH IN WHERE INDICATED REFER TO LUMINAIRE SCHEDULE
⊕	LIGHT FIXTURE, CEILING MOUNTED	PROVIDE ROUGH IN WHERE INDICATED REFER TO LUMINAIRE SCHEDULE
⊕	PENDANT LIGHT FIXTURE, CEILING MOUNTED	PROVIDE ROUGH IN WHERE INDICATED REFER TO LUMINAIRE SCHEDULE
⊕	LIGHT FIXTURE, WALL MOUNTED	PROVIDE ROUGH IN WHERE INDICATED REFER TO LUMINAIRE SCHEDULE
⊕EF	FAN, CEILING MOUNTED.	FURNISHED & INSTALLED BY MECH, WIRED BY ELECTRICAL CONTRACTOR
⊕	THERMOSTAT	FURNISHED & INSTALLED BY MECH
⊕	SMOKE DETECTOR & CARBON MONOXIDE DETECTOR	PART OF DESIGN/BUILD FIRE ALARM SYSTEM. SMOKE/CO DETECTORS TO BE WIRED TO FIRE ALARM SYSTEM.
⊕DB	DOOR BELL BUTTON	PROVIDE WHERE INDICATED.
⊕DBC	DOOR BELL CHIMES	PROVIDE WHERE INDICATED.
⊕DBT	DOOR BELL TRANSFORMER	PROVIDE WHERE INDICATED.
⊕MB	MULTIMEDIA BOX	PROVIDE WHERE INDICATED.
⊕	FAN COIL UNIT	FURNISHED & INSTALLED BY MECH (ELECTRICAL PROVIDE POWER TO THE UNIT PER NEC)
⊕	PHOTOCELL	EXTERIOR WEATHERPROOF PHOTOCELL CONTROL FOR DUSK TO DAWN OPERATION
⊕	WALL SWITCH, LOW VOLTAGE BATHROOM FAN SPEED CONTROL	FURNISHED & INSTALLED BY ELEC

NOTE: NOT ALL ITEMS USED ON PROJECT.

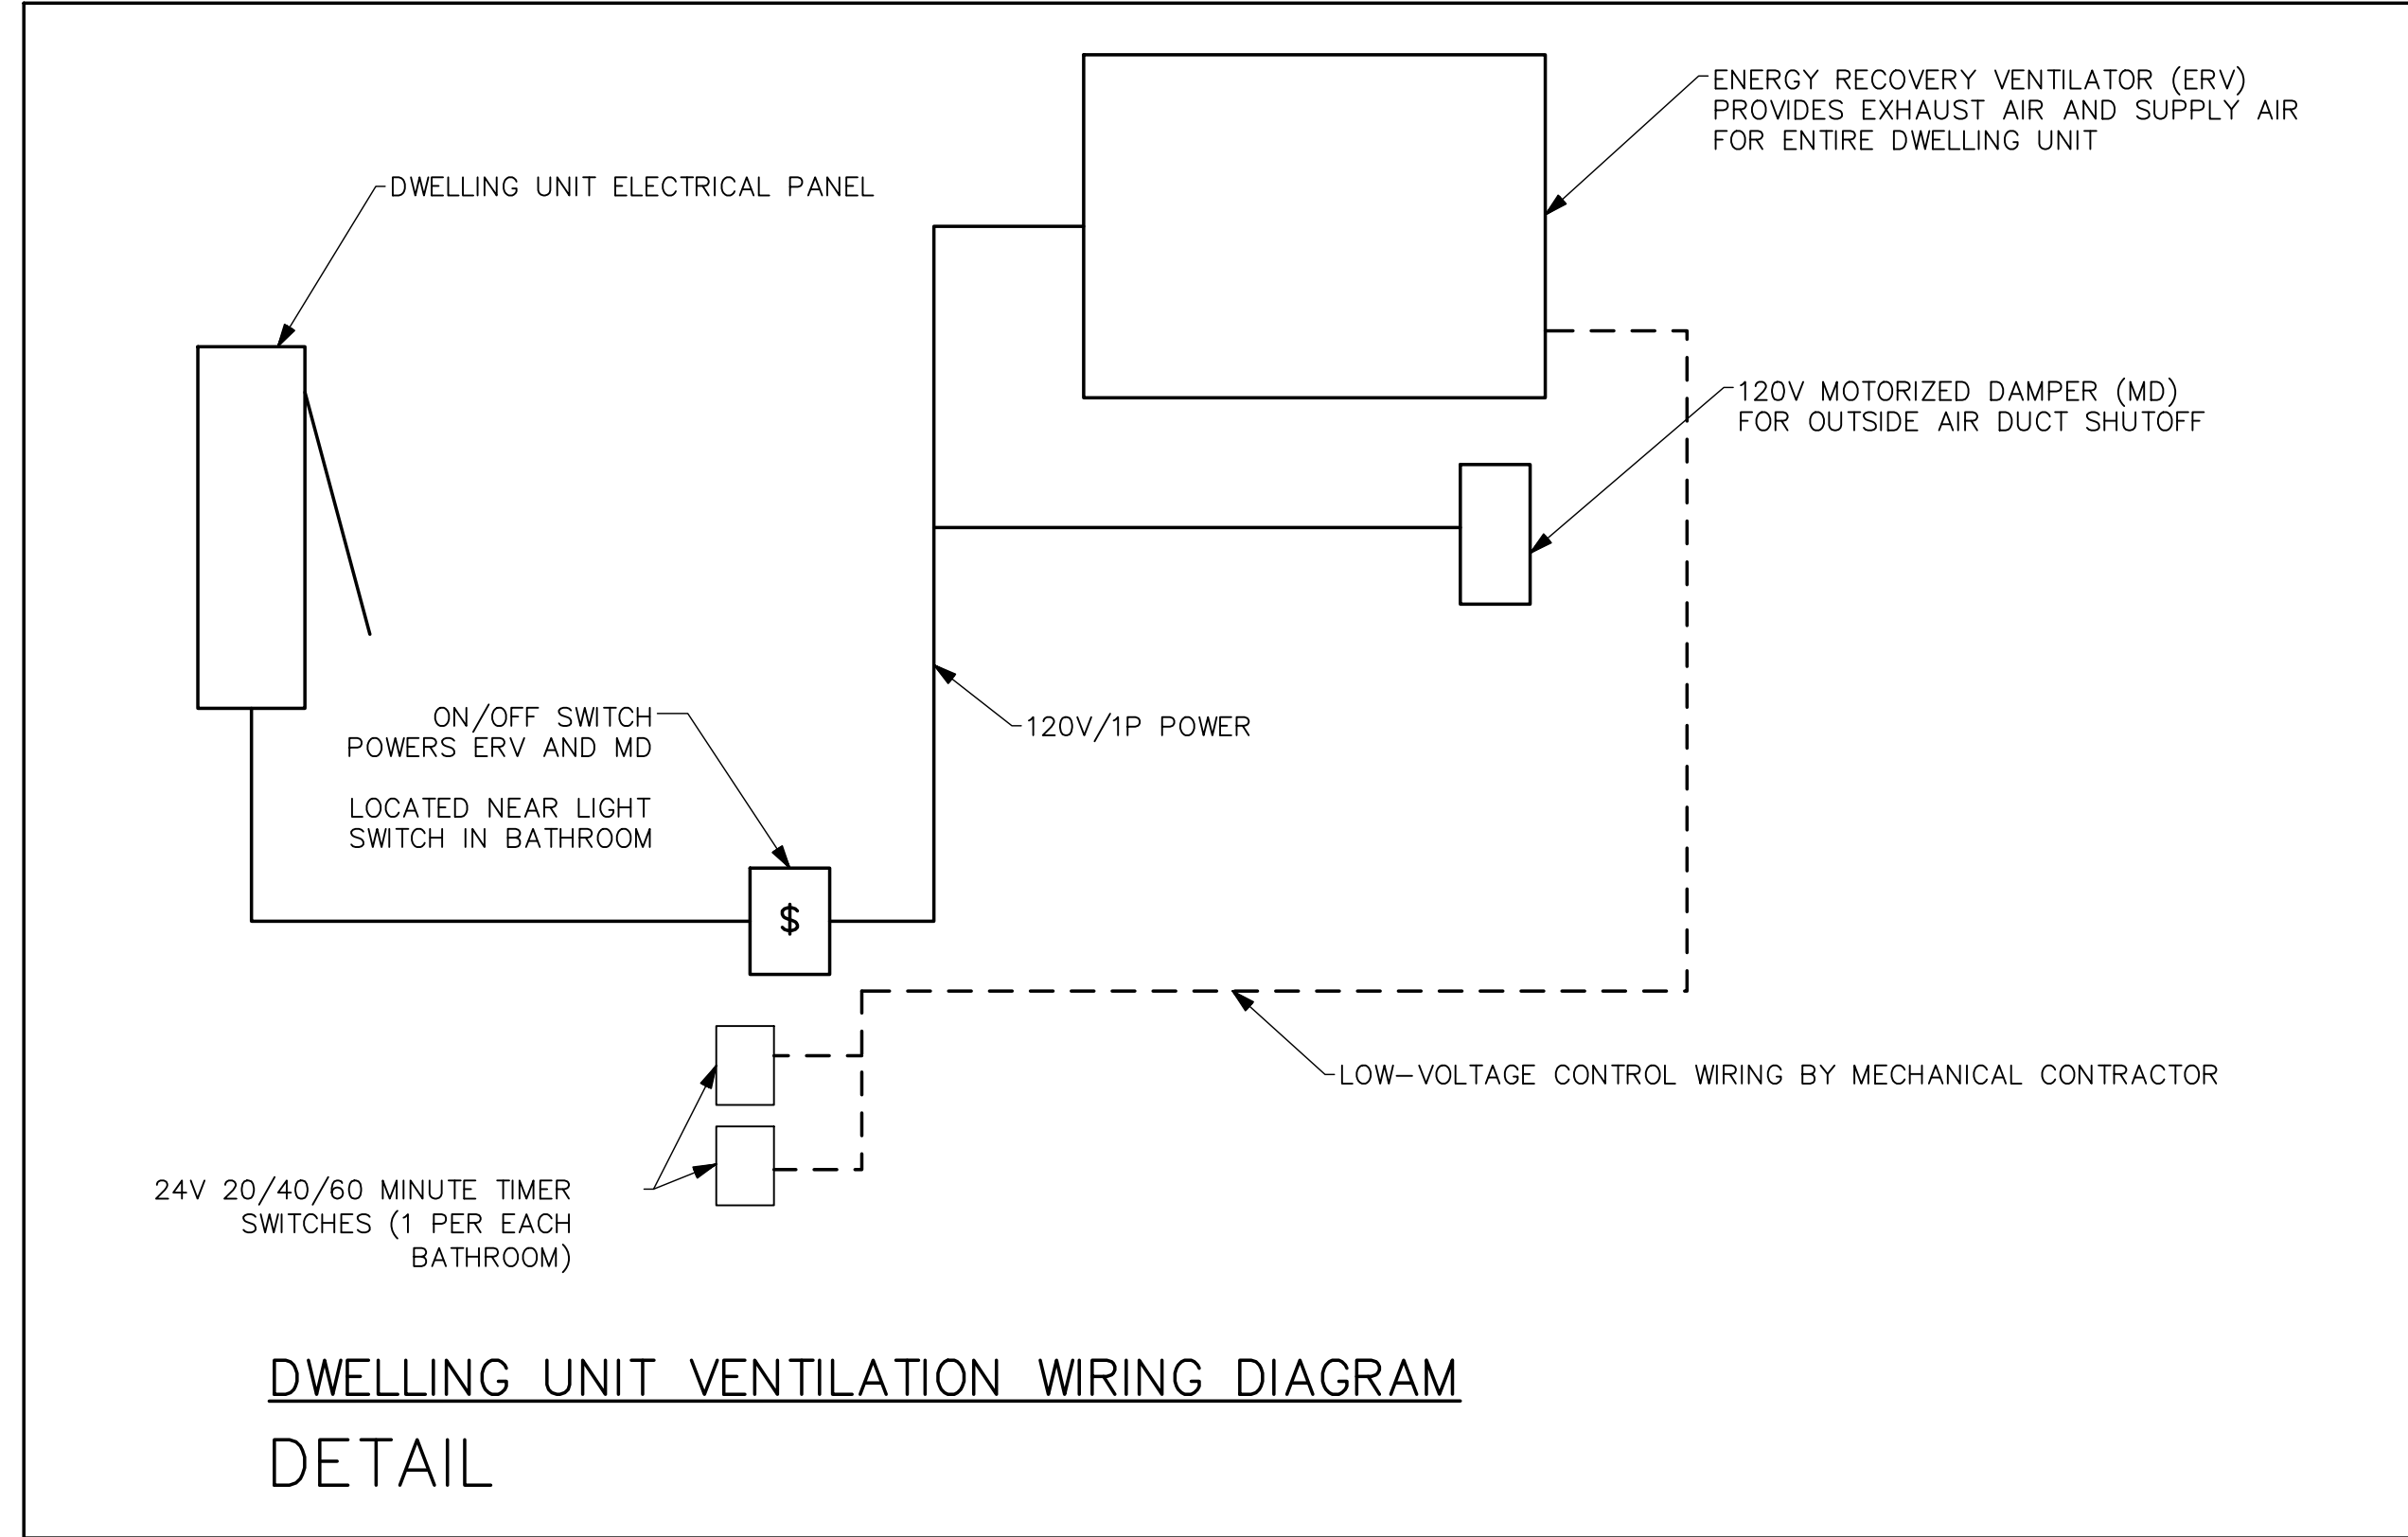

ELECTRIC HEATERS					
EQUIP NO.	SERVICE	MOUNTING/ DISCHARGE	HEATING KW	ELECTRICAL VOLTAGE	BASIS OF DESIGN
EWH-1	BEDROOM	WALL	1	208V/1P	KING WHF
EWH-0.75	BATHROOM	WALL	0.5	208V/1P	KING WHF

NOTES: (1) BROAN, CADET OR EQUIVALENT.
(2) PROVIDE REMOTE THERMOSTAT.

APARTMENT NOTES:

- ALL ELECTRICAL WORK SHALL COMPLY WITH ALL LOCAL AND NATIONAL CODES.
- DEVICE BOXES ON OPPOSITE SIDES OF DEMISING WALLS SHALL BE IN SEPARATE STUD BAYS. PROVIDE BACKING EQUIVALENT TO LOWRY'S OUTLET BOX PADS. CONDUIT FROM ONE UNIT SHALL NOT PASS THROUGH STUDS OF A SHARED WALL(DOUBLE STUDS) FROM AN ADJACENT UNIT(BRIDGING).
- PROVIDE ARC-FAULT PROTECTION, TAMPER PROOF AND GFCI RECEPTACLES AS REQUIRED BY CODE AND LOCAL AHJ. ARC-FAULT PROTECTION MUST BE PROVIDED FOR CIRCUITS IN THE AREAS LISTED IN NEC 210.12(A).
- PROVIDE SUFFICIENT DUPLEX RECEPTACLES TO MEET NEC 210.52.
- THERMOSTATS SHALL NOT INTERFERE WITH DOOR SWINGS.
- ELECTRICAL CONTRACTOR SHALL MAKE ALL FINAL CONNECTIONS FOR KITCHEN APPLIANCES. COORDINATE ALL J-BOX LOCATIONS WITH APPLIANCE INSTALLATION INSTRUCTIONS PRIOR TO ROUGH-IN.
- ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL CORD AND PLUG ASSEMBLY FOR EACH DISPOSER.
- PROVIDE A DEDICATED 20 AMP CIRCUIT TO EACH UNIT BATHROOM RECEPTACLE. BATHROOM LIGHTS, FAN TO BE ON SAME CIRCUIT PER 210.11(C)(3) EXCEPTION.
- HOME RUNS AND LOOPS CONNECTING LIGHT FIXTURES, WIRING DEVICES, AND HVAC EQUIPMENT ON PLANS INDICATE CIRCUITING SCHEME. SEE TYPICAL PANEL SCHEDULES FOR ACTUAL CIRCUIT NUMBERS FOR TYPICAL APARTMENT.
- LIGHTS WITHIN 3' HORIZONTAL OF SHOWER OR TUB TO BE WET LOCATION RATED AND HAVE FULLY ENCLOSED TRIMS. PROVIDE GFCI PROTECTION IF THE LUMINAIRE INSTALLATION MANUAL STATES IT IS REQUIRED.
- PROVIDE SMOKE DETECTORS AND CO ALARMS AS REQUIRED. DETECTORS AND ALARMS TO BE HARDWIRED AND PROVIDED WITH BATTERY BACKUP.
- ELECTRICAL CONTRACTOR SHALL INSTALL RECEPTACLES AND TV, DATA/PHONE OUTLETS UNDER COMMON COVER PLATE WHERE POSSIBLE. PROVIDE AND INSTALL DIVIDERS AS REQUIRED FOR CABLE/POWER SEPARATION.
- SEE ARCHITECTURAL DRAWINGS FOR DIMENSIONS AND LAYOUTS OF ALL DEVICES.
- ALL WALL PENETRATIONS SHALL BE CAULKED WITH APPROVED MATERIAL TO MAINTAIN THE FIRE RATING OF ALL WALLS AND FLOORS.
- ALL CONDUIT SHALL BE INSTALLED IN NEAT SYMMETRICAL LINES HORIZONTAL OR PERPENDICULAR TO BUILDING COLUMNS AND ROOF LINES. CONDUITS SHALL BE GROUPED ON COMMON SUPPORTS WHEREVER POSSIBLE.
- REFERENCE MECHANICAL DRAWINGS FOR EXACT LOCATION OF ALL MECHANICAL EQUIPMENT.
- ELECTRICAL CONTRACTOR SHALL VERIFY ALL FUSE RATING WIRE SIZES AND DISCONNECT SIZES WITH EQUIPMENT SERVED ON THE JOB PRIOR TO INSTALLATION.
- SEE ARCHITECTURAL DRAWINGS AND ELEVATIONS FOR ADDITIONAL DETAILS AND CASEWORK DIMENSIONS.
- DEVICE LOCATIONS IN 1ST DWELLING/RESIDENT UNIT SHALL BE REVIEWED AND APPROVED BY OWNER PRIOR TO ROUGH-IN OF REMAINING UNITS
- CONFIRM FINAL LOCATION OF HEATERS AND THERMOSTATS IN FIELD PRIOR TO ROUGH-IN

ACCESSIBILITY NOTES:

- ALL SWITCHES AND CONTROLS - 15" MIN; 48" MAX TO CONTROL.
- GENERAL OUTLETS MIN 18" AFF.
- ALL SWITCHES/CONTROLS ABOVE COUNTERTOPS 48" MAX.
- ELECTRICAL SUB-PANELS IN UNITS MUST COMPLY WITH ABOVE REACH RANGES.
- SWITCHES FOR EXHAUST HOODS AND GARBAGE DISPOSALS MUST COMPLY WITH ABOVE REACH RANGES. INSTALL SWITCHES ON FACE OF CABINETS IF REQUIRED TO COMPLY.

REVISIONS	DESCRIPTION	DATE
NO.		



DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: EAST TOWN CROSSING BUILDING F
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206-844-3363

ROBISON ENGINEERING, INC


PERMIT SET
03/08/2024

SHEET TITLE:
UNIT PLANS NOTES


SHEET NO.
E5.00

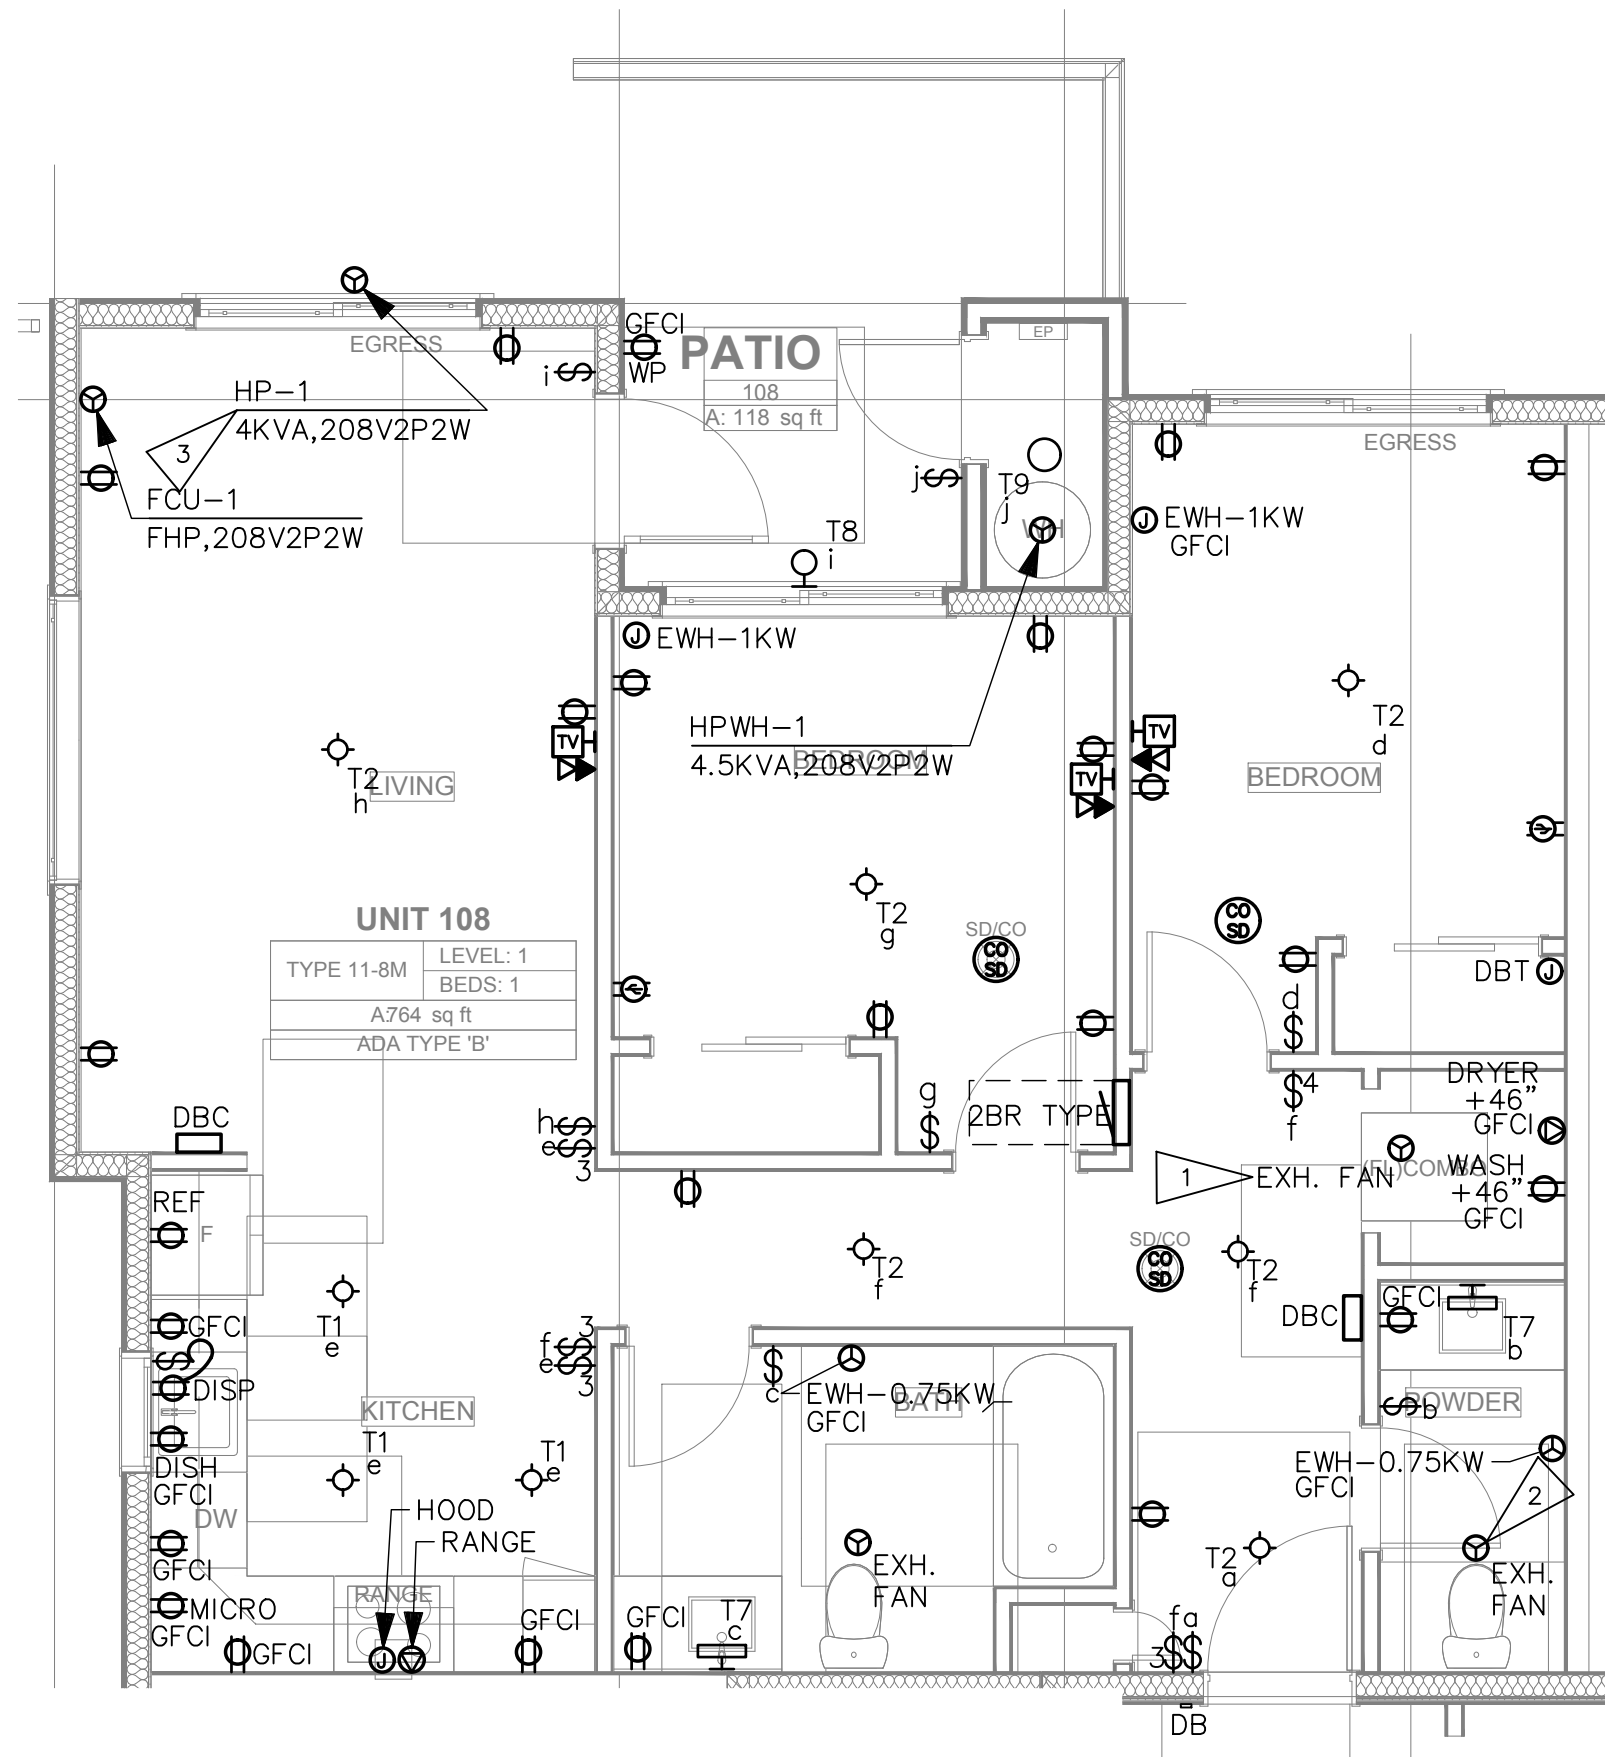


UNIT TYPICALS
 TYPE 11-8M 2BR
 SCALE: 1/4" = 1'-0"

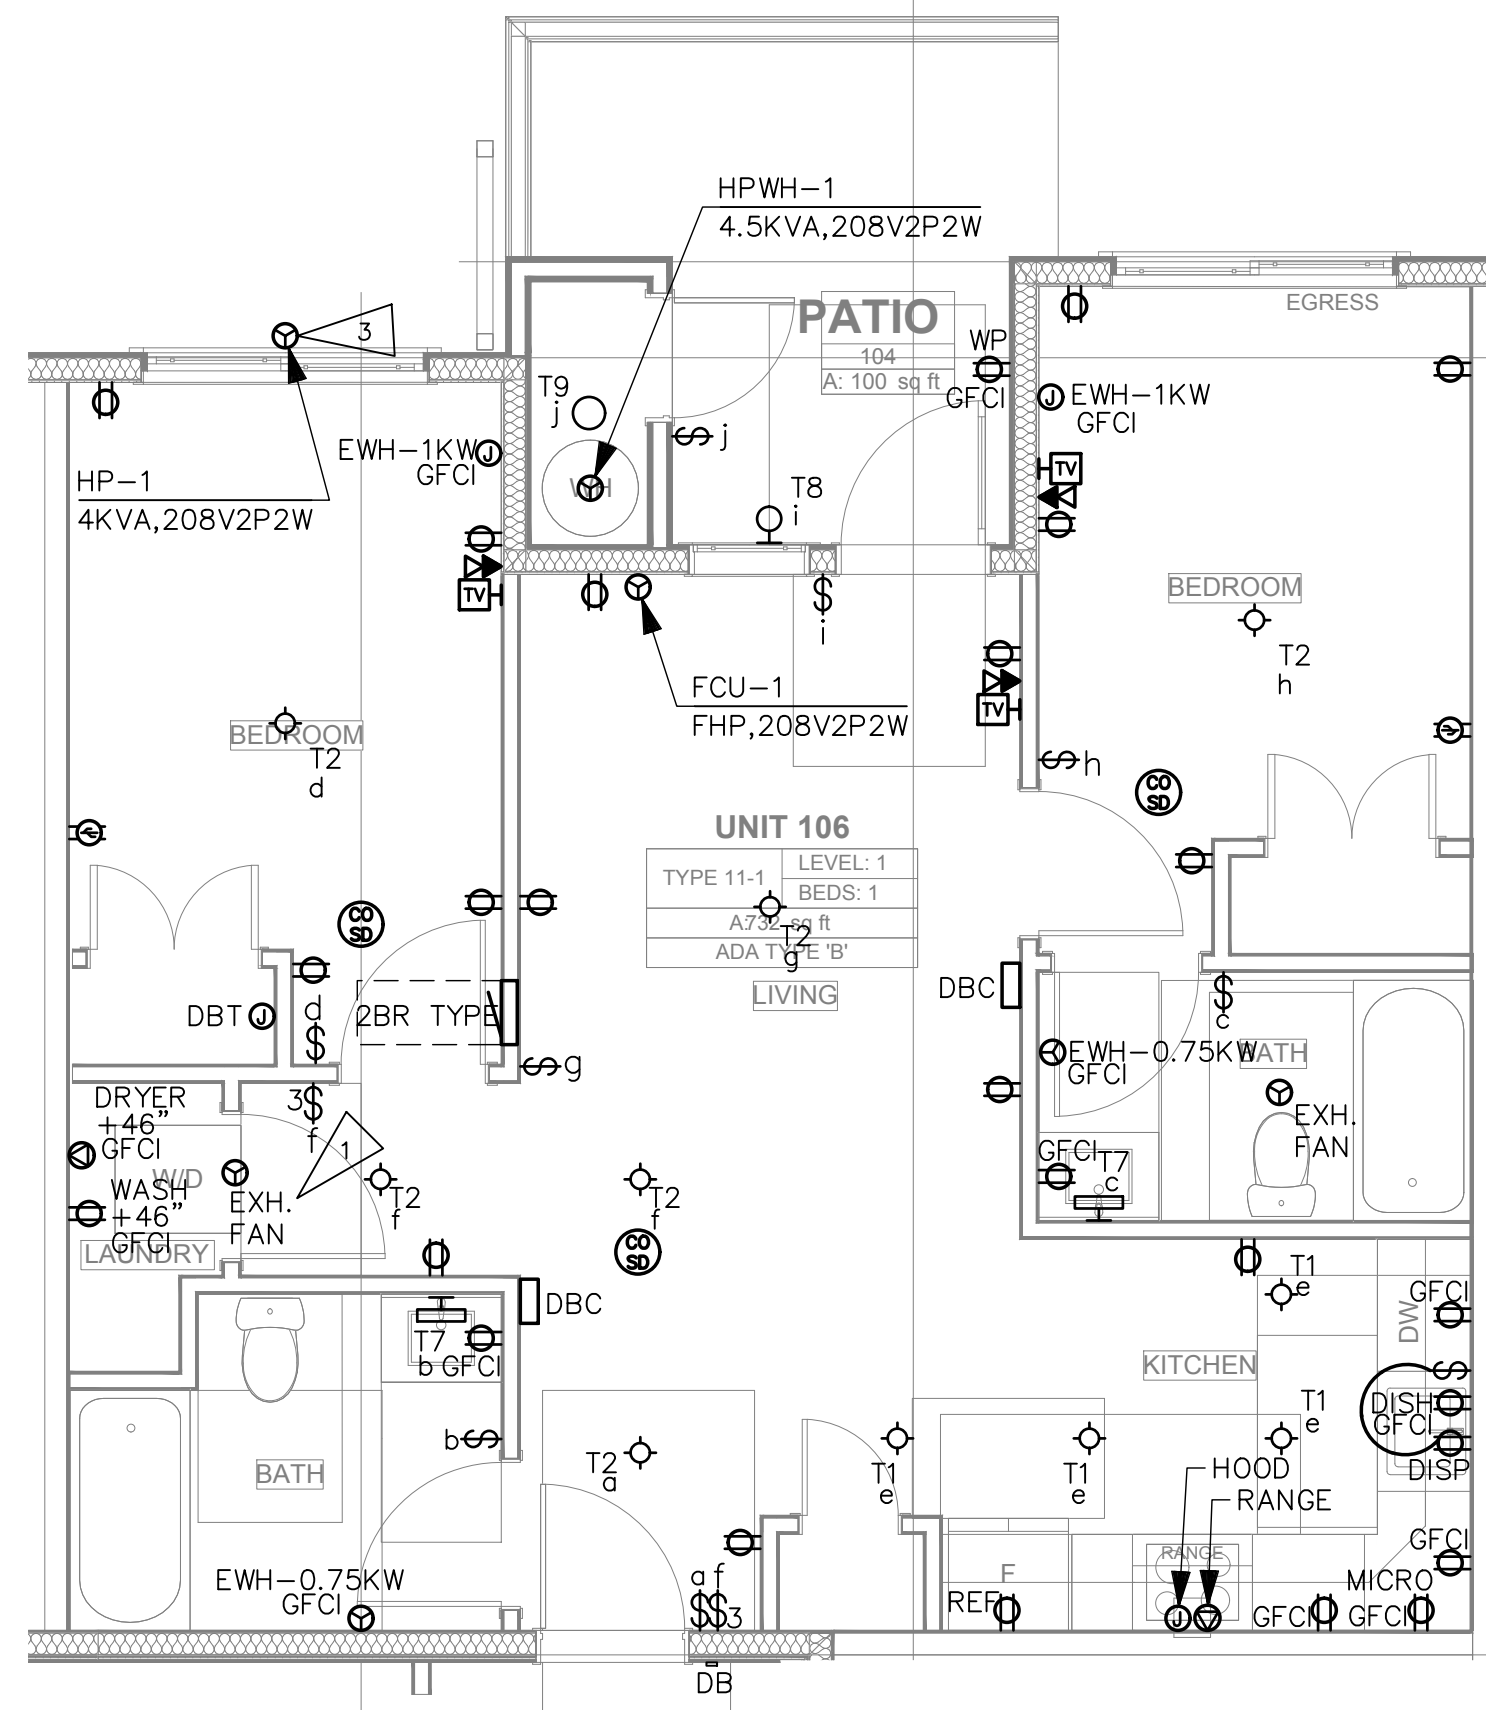

UNIT TYPICALS
 TYPE 11-1 2BR
 SCALE: 1/4" = 1'-0"

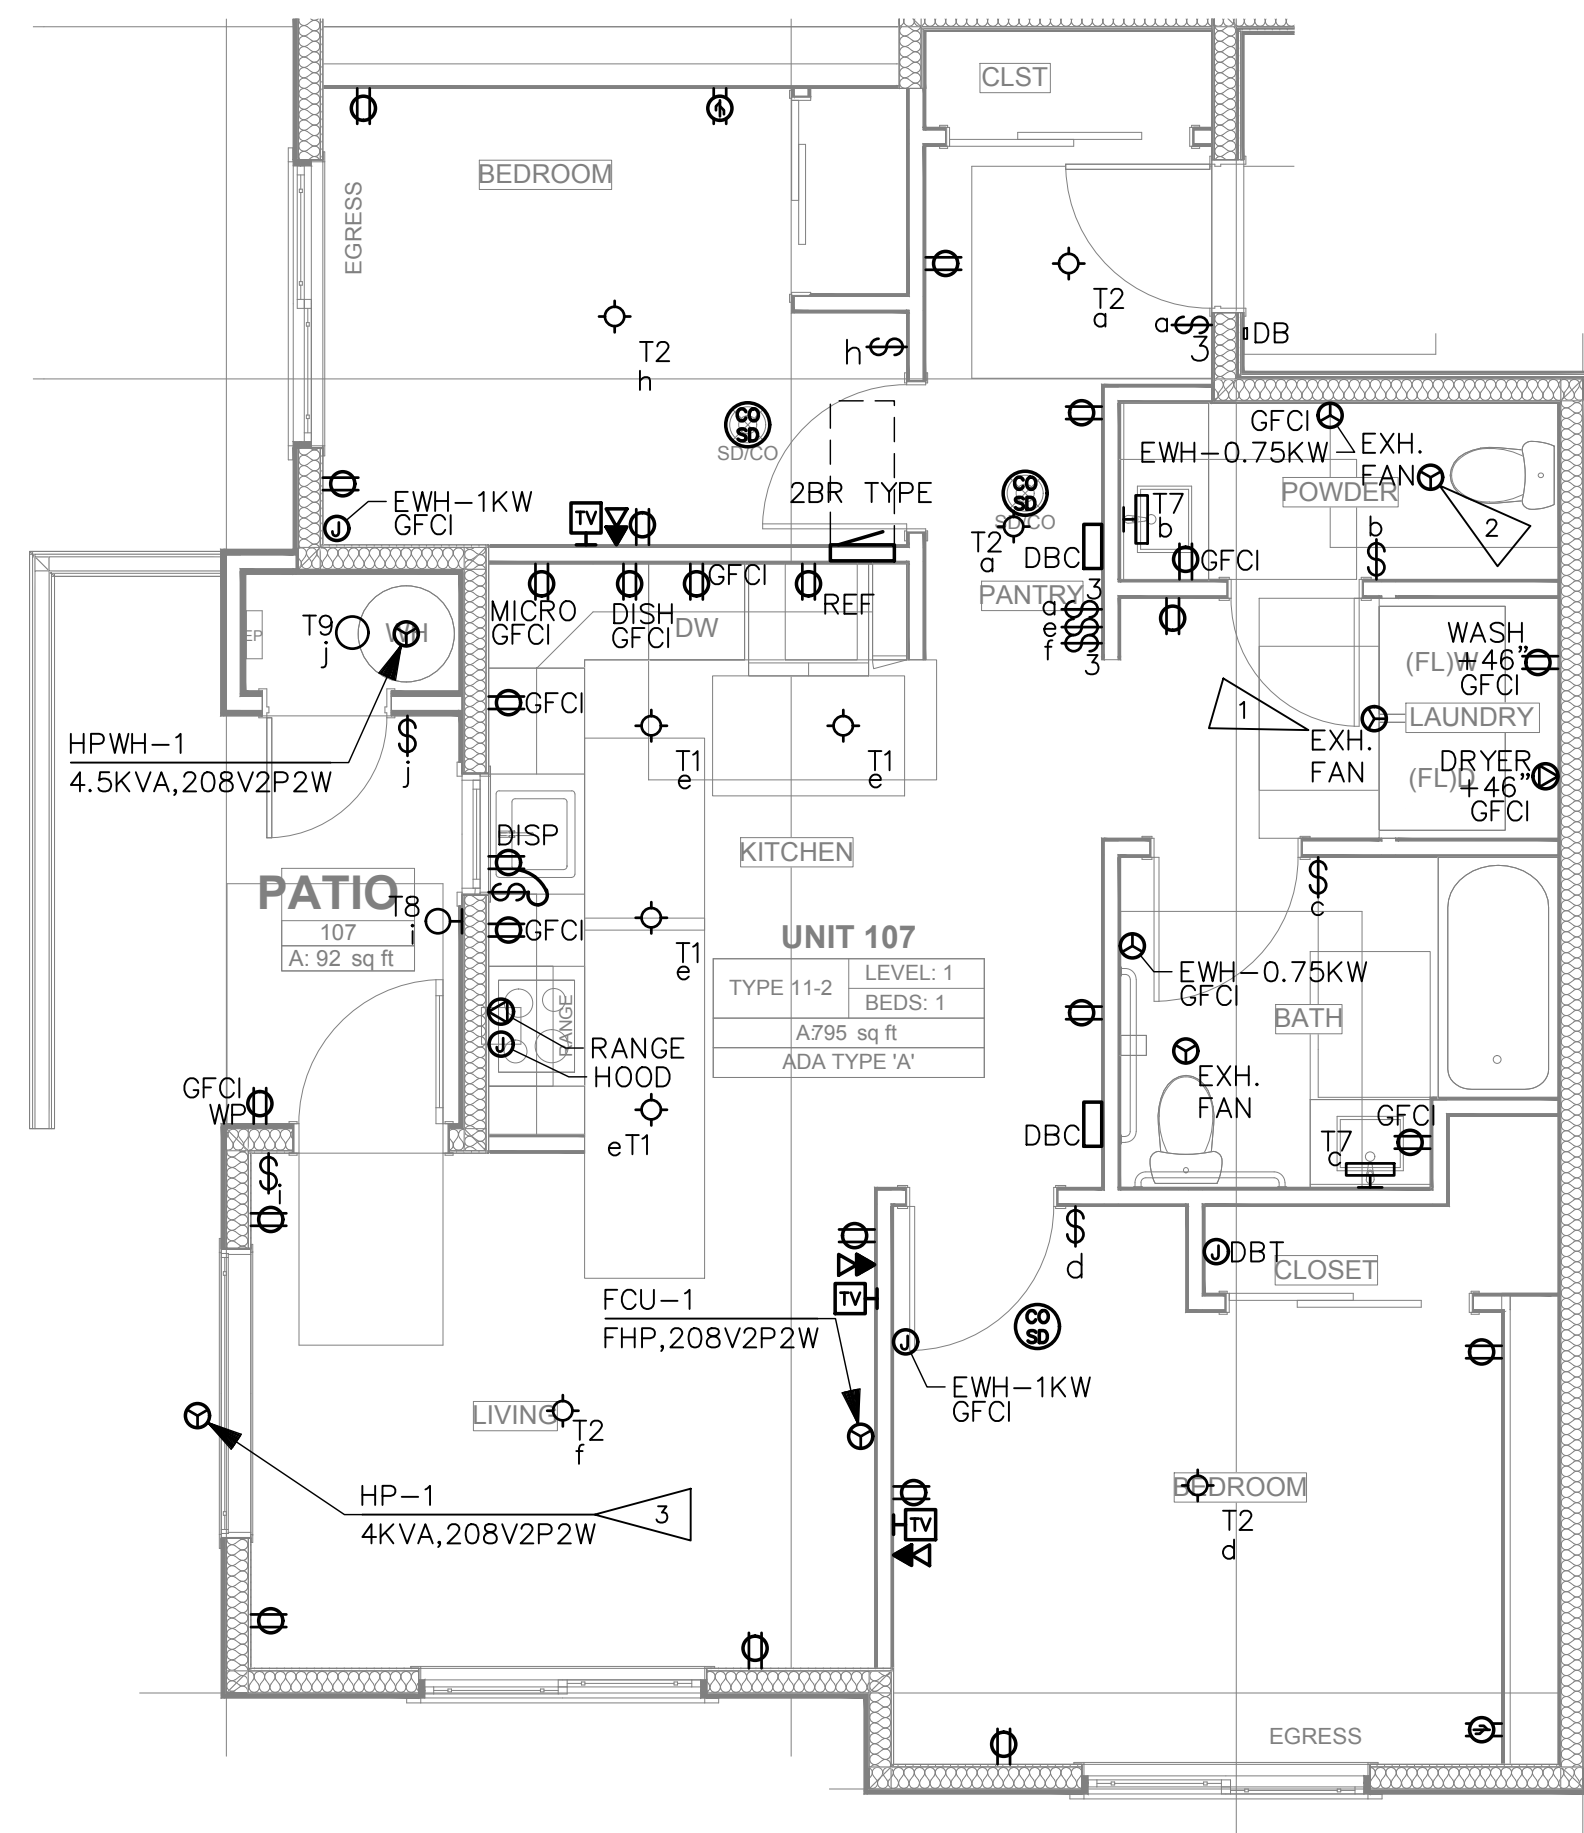

UNIT TYPICALS
 TYPE 11-2 2BR
 SCALE: 1/4" = 1'-0"

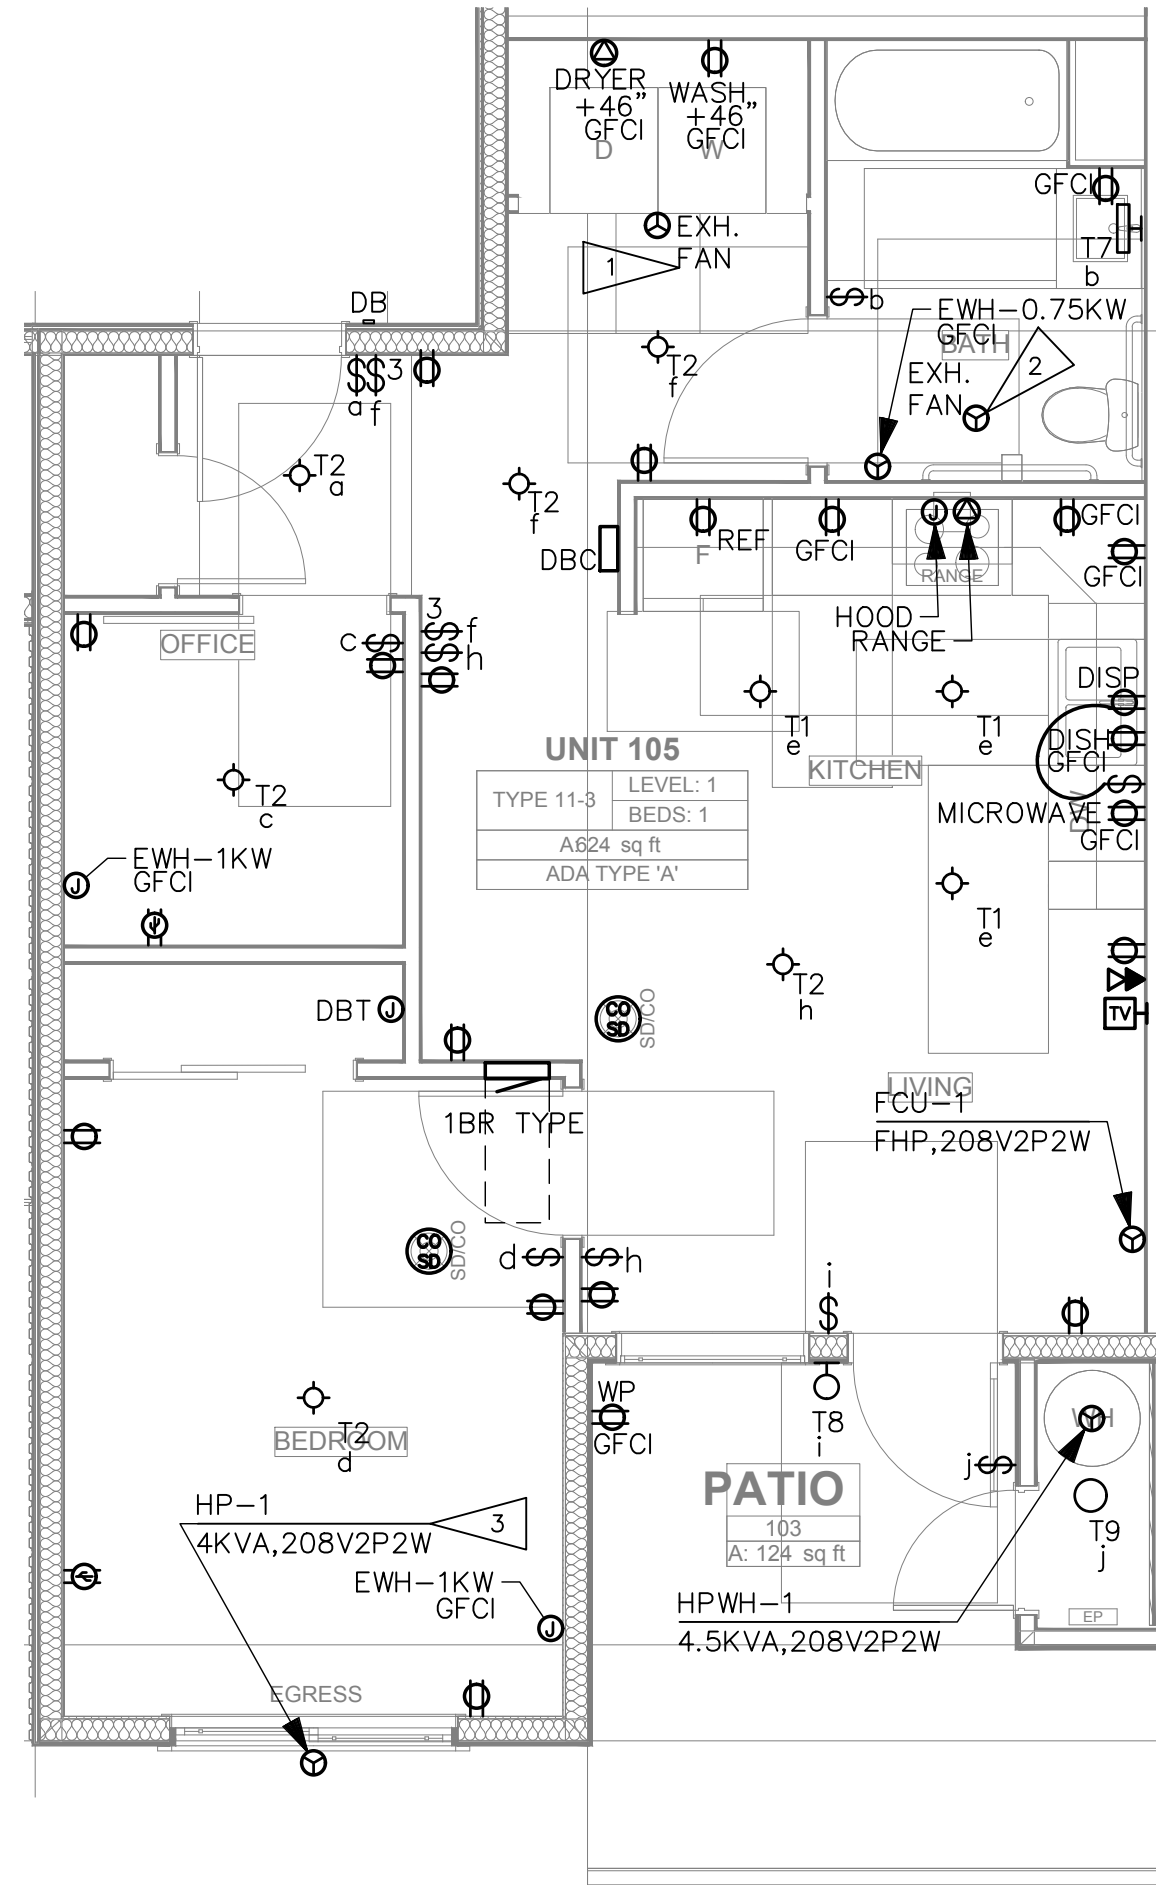

UNIT TYPICALS
 TYPE 12-3 3BR
 SCALE: 1/4" = 1'-0"

GENERAL NOTES:

1. PROVIDE AFCI BREAKERS PER NEC 210.12.
2. PROVIDE TAMPER RESISTANT RECEPTACLES PER NEC 406.12.
3. PROVIDE ADA COMPLIANT CONTROLS FOR RANGE HOODS & CEILING FANS IN UNITS DESIGNATED AS 'ACCESSIBLE' PER ARCHITECTURAL.

FLAG NOTES

1. LAUNDRY EXHAUST FAN CONTROLLED BY INTEGRAL HUMIDISTAT. PROVIDE UNSWITCHED HOT.
2. TWO-SPEED WHOLE HOUSE FAN CONTROLLED BY INTEGRAL OCCUPANCY SENSOR. HIGH SPEED OPERATION WHEN OCCUPIED, LOW SPEED OPERATION OTHERWISE. PROVIDE UNSWITCHED HOT.
3. REFER TO MECHANICAL PLANS FOR CONDENSING UNIT LOCATION

NO.	DATE	DESCRIPTION



DRAWN:	LYSAK K.
DESIGNED:	LYSAK K.
CHECKED:	STEINKE M.
APPROVED:	STEINKE M.

PROJECT: EAST TOWN CROSSING BUILDING F
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA


19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-834-1818

ROBISON ENGINEERING, INC.

PERMIT SET
 03/08/2024

SHEET TITLE:
UNIT PLANS

SHEET NO.
 E5.01

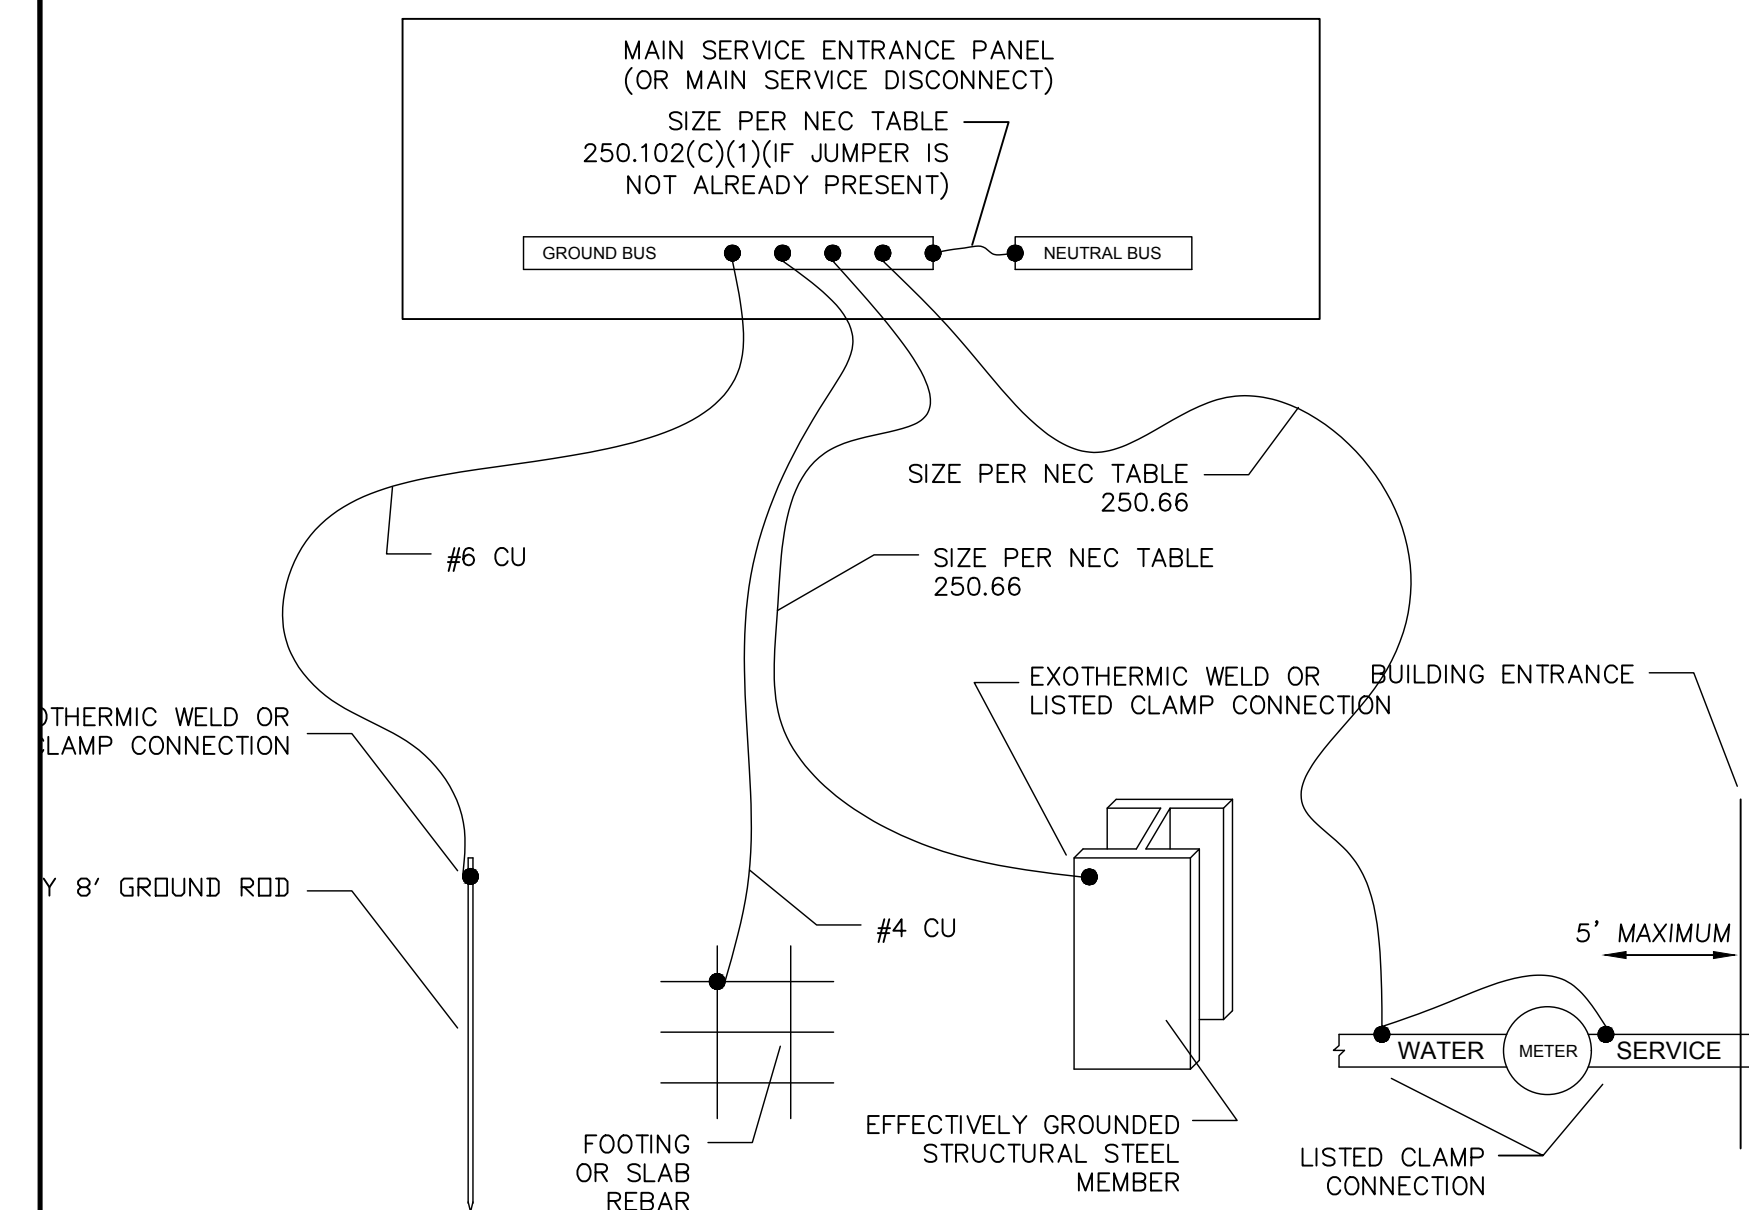

GEC DIAGRAM

ID	FEEDER AMPS	CONDUIT AND FEEDER	FEEDING THESE DEVICES
1	125	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G	101, 102, 103, 104, 105, 106, 107, 108, 201, 202, 203, 204, 205, 206, 207, 208, 301, 302, 303, 304, 305, 306, 307, 308
10	800	(3) 3" C, 3#400kcmil AL, #400kcmil AL N, #4/0 AL G	UTIL
11	400	(2) 2-1/2" C, 3#250kcmil AL, #250kcmil AL N, #1 AL G	HOUSE
12	1000	(4) 3" C, 3#350kcmil AL, #350kcmil AL N, #4/0 AL G	MC-G
14	300	3" C, 3#350kcmil, #350kcmil N, #4G	PV

SIZING METHOD: COPPER, 60°C #12 THROUGH #1, 75°C 1/0 AND ABOVE

FEEDER SCHEDULE NOTES:

CONDUIT FILL:

- * FOR CONDUIT SIZES 1-1/2" AND BELOW, FILL IS BASED ON EMT.
- * FOR CONDUIT SIZES 2" AND ABOVE, FILL IS BASED ON SCHEDULE 40 PVC.

IN LOCATIONS APPROVED FOR THE PURPOSE, CONTRACTOR MAY USE MC CABLE. IN LOCATIONS APPROVED FOR THE PURPOSE CONTRACTOR MAY USE OTHER CONDUIT TYPES, INCLUDING RMC, FMC AND LFMC. CONTRACTOR REQUIRED TO ENSURE CONDUIT FILL DOES NOT EXCEED 40%.

CONTRACTOR RESPONSIBLE TO ENSURE TERMINATION/LUG CAPACITY FOR ALL SCHEDULED FEEDERS.



XHHW/THHN/THWN SHALL BE USED FOR INSULATION OF THE CONDUCTOR.

PHASE 1 EV BREAKDOWN: 290 PARKING SPACES * 0.2 = 58 EV CHARGERS					
Bldg	# EV chargers	208V 1PH load (KVA)	208/120V 3PH load (A)	50% load management infrastructure (KVA)	50% load management infrastructure (A)
B	6	49.92	138.57	24.96	69.29
C	6	49.92	138.57	24.96	69.29
D	6	49.92	138.57	24.96	69.29
G	20	166.4	461.9	83.2	230.95
H	4	33.28	92.38	16.64	46.19
TI.1	3	24.96	69.29	12.48	34.65
TI.2-4	13	108.16	300.24	54.08	150.12
Total	58	482.56	1339.5	241.28	669.75

FAULT CURRENT SCHEDULE

DEVICE	FAULT	AIC RATING	L-N VOLTS	UTILITY FAULT	FED FROM		FEEDER		TOTAL MOTOR FAULT
					DEVICE	FAULT	SIZE	LENGTH	
UTIL	29,712	NA	120V	29,100					612
MC-G	22,678	42,000	120V	22,063	UTIL	29,100	(4)#350kcmil AL	92'	615
HOUSE	18,481	42,000	120V	18,049	MC-G	22,063	(2)#250kcmil AL	29'	432
PV	16,770	22,000	120V	16,417	HOUSE	18,049	#350kcmil	12'	353
101	9,789	22,000	120V	9,662	MC-G	22,063	#2/0 AL	50'	127
102	13,494	22,000	120V	13,265	MC-G	22,063	#2/0 AL	28'	229
103	9,274	22,000	120V	9,158	MC-G	22,063	#2/0 AL	54'	116
104	11,156	22,000	120V	10,996	MC-G	22,063	#2/0 AL	40'	160
105	6,872	22,000	120V	6,800	MC-G	22,063	#2/0 AL	83'	72
106	7,028	22,000	120V	6,953	MC-G	22,063	#2/0 AL	80'	75
107	5,057	22,000	120V	5,009	MC-G	22,063	#2/0 AL	122'	48
108	5,965	22,000	120V	5,906	MC-G	22,063	#2/0 AL	99'	59
201	7,380	22,000	120V	7,299	MC-G	22,063	#2/0 AL	75'	81
202	9,407	22,000	120V	9,289	MC-G	22,063	#2/0 AL	53'	118
203	7,076	22,000	120V	7,001	MC-G	22,063	#2/0 AL	80'	75
204	8,156	22,000	120V	8,063	MC-G	22,063	#2/0 AL	65'	93
205	5,570	22,000	120V	5,516	MC-G	22,063	#2/0 AL	108'	54
206	5,673	22,000	120V	5,617	MC-G	22,063	#2/0 AL	106'	56
207	4,310	22,000	120V	4,269	MC-G	22,063	#2/0 AL	147'	41
208	4,956	22,000	120V	4,908	MC-G	22,063	#2/0 AL	125'	48
301	6,780	22,000	120V	6,709	MC-G	22,063	#2/0 AL	84'	71
302	8,470	22,000	120V	8,370	MC-G	22,063	#2/0 AL	62'	100
303	6,522	22,000	120V	6,456	MC-G	22,063	#2/0 AL	89'	66
304	7,435	22,000	120V	7,354	MC-G	22,063	#2/0 AL	74'	81
305	5,218	22,000	120V	5,168	MC-G	22,063	#2/0 AL	117'	50
306	5,308	22,000	120V	5,257	MC-G	22,063	#2/0 AL	115'	51
307	4,096	22,000	120V	4,056	MC-G	22,063	#2/0 AL	156'	40
308	4,675	22,000	120V	4,630	MC-G	22,063	#2/0 AL	134'	45

208Y/120V 3P 4W
 225 KVA
 FC 29,712

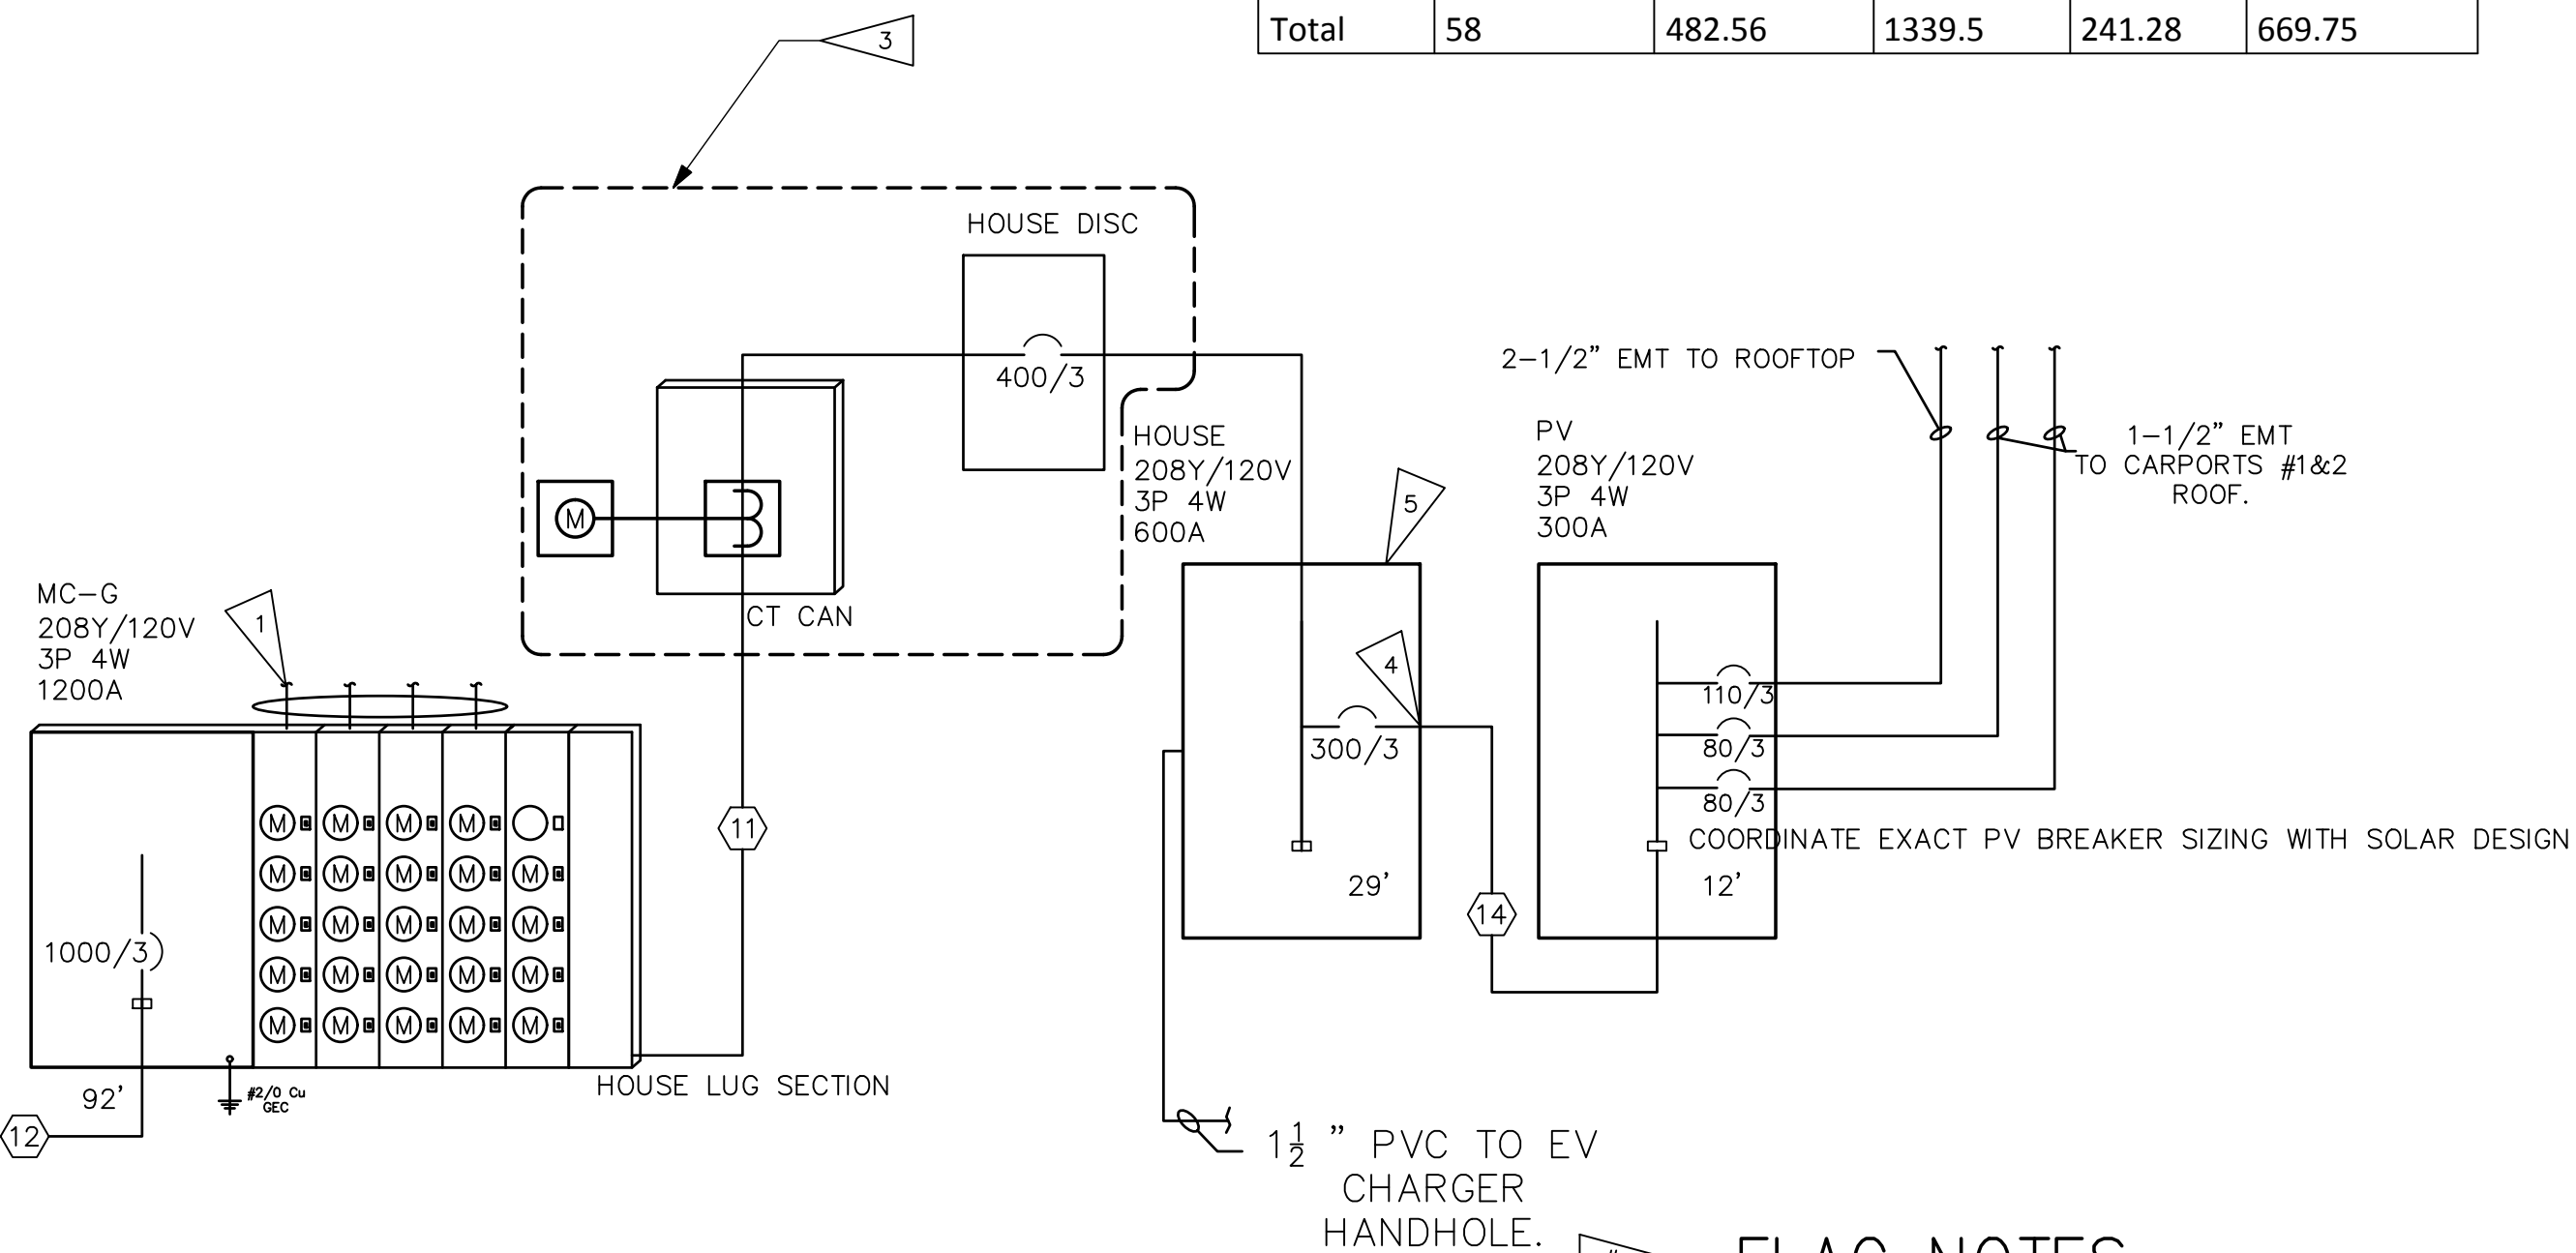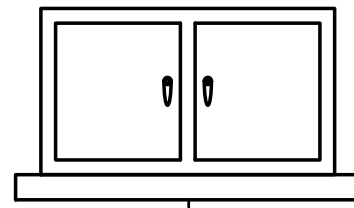

FLAG NOTES

- 1 UNIT FEEDERS: REFER TO METER CENTER PANEL SCHEDULE ON THIS SHEET FOR UNIT FEEDER SIZE & TYPE. TYP.
- 2 CONTRACTOR SHALL VERIFY AVAILABLE FAULT CURRENT WITH PSE SERVICE LETTER PRIOR TO ORDERING EQUIPMENT.
- 3 HOUSE PANEL METER AND MAIN BREAKER.
- 4 PROVISIONAL BREAKER SPACE AND CONDUIT FOR FUTURE PV SYSTEM. LOCATE BREAKER SPACE AT
- 5 BUSBAR SIZED PER NEC 705.12(B)(2).

ONE-LINE DIAGRAM

SCALE: NONE

REQUIRED ELECTRIC VEHICLE CHARGING INFRASTRUCTURE WAC 51-50-0429:

- WHERE PARKING IS PROVIDED, TEN PERCENT OF PARKING SPACES SHALL BE PROVIDED WITH ELECTRIC VEHICLE CHARGING INFRASTRUCTURE.
- ELECTRICAL ROOM(S) SERVING PARKING AREAS SHALL BE DESIGNED TO ACCOMMODATE THE ELECTRICAL EQUIPMENT AND DISTRIBUTION REQUIRED TO SERVE A MINIMUM OF 20 PERCENT OF THE TOTAL PARKING SPACES WITH 208/240 V 40-AMP ELECTRIC VEHICLE CHARGING INFRASTRUCTURE.
- MINIMUM ONE ACCESSIBLE PARKING SPACE SHALL BE SERVED BY ELECTRIC VEHICLE CHARGING INFRASTRUCTURE.

TOTAL NUMBER OF PARKING SPACES = 458; 458 x 0.2 = CAPACITY FOR 92 EV CHARGERS
 92 CHARGERS x 208V/1PH x 40A = 765.44 KVA = 2,126.22 A 3 PHASE POWER @ 120/208V

UTILIZING LOAD MANAGEMENT INFRASTRUCTURE, EV LOAD CAN BE REDUCED BY 50%. 2,126.22A/2 = 382.72 KVA (1,063.11 A) @ 208V 3 PHASE.

PER WAC 427, ELECTRICAL INFRASTRUCTURE SHALL BE DESIGNED TO ACCOMMODATE AN ADDITIONAL 1,064 AMPS OF ELECTRICAL LOAD.

NO.	DATE	DESCRIPTION



DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: EAST TOWN CROSSING BUILDING F
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-864-3343

ROBISON ENGINEERING, INC.

PERMIT SET
 03/08/2024

SHEET TITLE:
 ONE-LINE DIAGRAM & PANELS SCHEDULES

SHEET NO.
 E6.00

MC-G						
ROOM MOUNTING FLUSH		VOLTS 208Y/120V 3P 4W		AIC 42,000		
FED FROM UTIL		BUS AMPS 1200		MAIN BKR MLO		
NOTE		NEUTRAL 100%		LUGS STANDARD		
CKT #	BREAKER TRIP/POLES	CIRCUIT DESCRIPTION	LOAD KVA			FEEDER RACEWAY AND CONDUCTORS
			A	B	C	
1	125/2	PANEL 101	19.7	19.8	19.8	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
2	125/2	PANEL 102	18.4	19.7	18.3	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
3	125/2	PANEL 103	19.7	19.8	18.4	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
4	125/2	PANEL 104	19.8	19.7	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
5	125/2	PANEL 105	19.7	19.8	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
6	125/2	PANEL 106	19.7	19.8	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
7	125/2	PANEL 107	19.7	19.8	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
8	125/2	PANEL 108	19.7	19.8	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
9	125/2	PANEL 201	19.7	19.8	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
10	125/2	PANEL 202	19.7	19.8	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
11	125/2	PANEL 203	18.3	18.4	18.4	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
12	125/2	PANEL 204	19.8	19.7	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
13	125/2	PANEL 205	18.3	18.4	18.4	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
14	125/2	PANEL 206	19.7	19.8	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
15	125/2	PANEL 207	19.8	19.7	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
16	125/2	PANEL 208	19.7	19.8	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
17	125/2	PANEL 301	19.7	19.8	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
18	125/2	PANEL 302	19.8	19.7	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
19	125/2	PANEL 303	18.3	18.4	18.4	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
20	125/2	PANEL 304	19.7	19.8	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
21	125/2	PANEL 305	18.4	18.3	18.3	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
22	125/2	PANEL 306	19.7	19.8	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
23	125/2	PANEL 307	19.7	19.8	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
24	125/2	PANEL 308	19.8	19.7	19.7	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G
25	400/3	PANEL HOUSE	42.2	41.8	41.9	(2)2-1/2"C,3#250kcmil AL,#250kcmil AL N,#1 AL G
26	-/2	SPACE	0	0	0	
TOTAL CONNECTED KVA BY PHASE			352	352	352	
OPTIONAL MULTIFAMILY DWELLING CALCULATION (NEC 220.84)						
DWELLING UNIT LOADS						
KVA			KVA			
LIGHTING AND RECEPTACLES	76.5	25,500 SF (3 VA/SF)	CONNECTED LOAD	874		
SMALL-APPLIANCE	72		DWELLING UNITS	24		
LAUNDRY	36		DEMAND FACTOR	(35%)		
APPLIANCES	386		CALCULATED LOAD	306		
ELECTRIC COOKING	194					
MOTORS	28.8	(100%)				
HEATING	79.5					
HOUSE LOADS						
	CONN KVA	CALC KVA		CONN KVA	CALC KVA	
LIGHTING	0.614	0.768 (125%)	RECEPTACLES	2.7	2.7 (50%>10)	
LARGEST MOTOR	2.83	0.707 (25%)	EV LOAD	39.6	49.5 (125%)	
MOTORS	5.65	5.65 (100%)	PV LOAD	77.4	0 (0%)	
TOTAL HOUSE LOAD			59.3			
TOTAL LOAD						
	KVA		KVA			
TOTAL DWELLING UNIT LOAD	306		TOTAL LOAD	365		
TOTAL HOUSE LOAD	59.3		BALANCED 3-PHASE LOAD	1,010 A		


HOUSE							
ROOM MOUNTING FLUSH		VOLTS 208Y/120V 3P 4W		AIC 42,000			
FED FROM MC-G		BUS AMPS 600		MAIN BKR MLO			
NOTE		NEUTRAL 100%		LUGS STANDARD			
CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION	CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION
3	20/1	0.54	RECEPTACLE	b 4			
5	20/1	0.54	RECEPTACLE	c 6	20/1	0.1	SITE LIGHTING
7	20/1	0.36	RECEPTACLE	a 8	20/1	0.207	LIGHTING
9	20/1	0.18	FACP	b 10	20/1	0.207	LIGHTING
11	20/1	0.36	RECEPTACLE	c 12	20/3	5.65	BP-1
13	40/2	6.6	DUAL EV CHARGER	a 14			
15				b 16			
17	40/2	6.6	DUAL EV CHARGER	c 18	-/1	0	SPACE
19				a 20	-/1	0	SPACE
21	40/2	6.6	DUAL EV CHARGER	b 22	-/1	0	SPACE
23				c 24	-/1	0	SPACE
25	40/2	6.6	DUAL EV CHARGER	a 26	-/1	0	SPACE
27				b 28	-/1	0	SPACE
29	40/2	6.6	DUAL EV CHARGER	c 30	-/1	0	SPACE
31				a 32	-/1	0	SPACE
33	40/2	6.6	DUAL EV CHARGER	b 34	-/1	0	SPACE
35				c 36	-/1	0	SPACE
37	-/1	0	SPACE	a 38	300/3	77.4	PANEL PV
39	-/2	0	SPACE	b 40			
41				c 42			
CONN KVA			CALC KVA	CONN KVA			CALC KVA
LIGHTING	0.614	0.768 (125%)	MOTORS	5.65	5.65 (100%)		
LARGEST MOTOR	2.83	0.707 (25%)	RECEPTACLES	2.7	2.7 (50%>10)		
			EV LOAD	39.6	49.5 (125%)		
			PV LOAD	77.4	0 (0%)		
TOTAL LOAD			59.3				
BALANCED 3-PHASE LOAD			165 A				
PHASE A			101%				
PHASE B			99.7%				
PHASE C			99.8%				

2 BED YP							
ROOM MOUNTING FLUSH		VOLTS 208/120V 2P 3W		AIC 22,000			
FED FROM		BUS AMPS 125		MAIN BKR MLO			
NOTE		NEUTRAL 100%		LUGS STANDARD			
CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION	CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION
3	15/1	1	OFFICE R/L	b 4	20/1	1.5	SML APPLIANCE/DINING
5	15/1	1	BED RM R/L	a 6	20/1	0.8	DISHWASHER
7	15/1	1	BED RM R/L	b 8	20/1	1.2	DISPOSAL
9	20/1	1	BATHROOM REC/LTG	a 10	40/2	8.1	RANGE
11	20/1	1	BATHROOM REC/LTG	b 12			
13	20/2	1.5	WALL HEATER BATHS	a 14	20/1	1.8	MICRO/HOOD
15				b 16	30/2	5	DRYER
17	20/2	2	WALL HEATER BEDS	a 18			
19				b 20	20/1	1.5	WASHER
21	30/2	4	HEAT PUMP, FCU-1	a 22	-/1	0	SPACE
23				b 24	-/1	0	SPACE
25	30/2	4.5	HPWH-1	a 26	-/1	0	SPACE
27				b 28	-/1	0	SPACE
29	-/1	0	SPACE	a 30	-/1	0	SPACE
CONN KVA			CALC KVA	CONN KVA			CALC KVA
LIGHTING AND RECEPTACLES	3.12	1,040 SF (3 VA/SF)	GENERAL LOAD	10	10 (100%)		
SMALL-APPLIANCE	3		UP TO 10 KVA	23	9.21 (40%)		
LAUNDRY	1.5		OVER 10 KVA	2.28	(220.82(C)(4))		
APPLIANCES	16.1		MAX HEATING OR COOLING	2.28	(220.82(C)(4))		
ELECTRIC COOKING	8.1		TOTAL LOAD	21.5			
MOTORS	1.2		BALANCED LOAD	103 A			
TOTAL GENERAL LOAD			33				
PHASE A			99.8%				
PHASE B			100%				

PV							
ROOM MOUNTING FLUSH		VOLTS 208Y/120V 3P 4W		AIC 22,000			
FED FROM HOUSE		BUS AMPS 300		MAIN BKR MLO			
NOTE		NEUTRAL 100%		LUGS STANDARD			
CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION	CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION
3				b 4	-/1	0	SPACE
5				c 6	-/1	0	SPACE
7	30/3	5.88	SOUTH ARRAY 12 PANELS	a 8	-/1	0	SPACE
9				b 10	-/1	0	SPACE
11				c 12	-/1	0	SPACE
13	20/3	3.92	SOUTH ARRAY 8 PANELS	a 14	-/1	0	SPACE
15				b 16	-/1	0	SPACE
17				c 18	-/1	0	SPACE
19	30/3	5.88	EAST ARRAY 12 PANEL	a 20	-/1	0	SPACE
21				b 22	-/1	0	SPACE
23				c 24	-/1	0	SPACE
25	80/3	21.5	CARPORIT 1 50 PANELS	a 26	-/1	0	SPACE
27				b 28	-/1	0	SPACE
29				c 30	-/1	0	SPACE
31	-/1	0	SPACE	a 32	-/1	0	SPACE
33	-/1	0	SPACE	b 34	-/1	0	SPACE
35	-/1	0	SPACE	c 36	-/1	0	SPACE
37	-/1	0	SPACE	a 38	-/1	0	SPACE
39	-/1	0	SPACE	b 40	-/1	0	SPACE
41	-/1	0	SPACE	c 42	-/1	0	SPACE
CONN KVA			CALC KVA	CONN KVA			CALC KVA
PV LOAD	77.4	0 (0%)	TOTAL LOAD	0			
BALANCED 3-PHASE LOAD			0 A				
PHASE A			100%				
PHASE B			100%				
PHASE C			100%				

1 BED YP							
ROOM MOUNTING FLUSH		VOLTS 208/120V 2P 3W		AIC 22,000			
FED FROM		BUS AMPS 125		MAIN BKR MLO			
NOTE		NEUTRAL 100%		LUGS STANDARD			
CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION	CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION
3	15/1	1	BED RM R/L	b 4	20/1	1.5	SML APPLIANCE/DINING
5	15/1	1	BED RM R/L	a 6	20/1	0.8	DISHWASHER
7	20/1	1	BATHROOM REC/LTG	b 8	20/1	1.2	DISPOSAL
9	20/2	2	WALL HEATER BEDS	a 10	40/2	8.1	RANGE
11				b 12			
13	20/2	0.75	WALL HEATER BATH	a 14	20/1	1.8	MICRO/HOOD
15				b 16	30/2	5	DRYER
17	30/2	4	HEAT PUMP, FCU-1	a 18			
19				b 20	20/1	1.5	WASHER
21	30/2	4.5	HPWH-1	a 22	-/1	0	SPACE
23				b 24	-/1	0	SPACE
25	-/1	0	SPACE	a 26	-/1	0	SPACE
27	-/1	0	SPACE	b 28	-/1	0	SPACE
29	-/1	0	SPACE	a 30	-/1	0	SPACE
CONN KVA			CALC KVA	CONN KVA			CALC KVA
LIGHTING AND RECEPTACLES	3.39	1,130 SF (3 VA/SF)	GENERAL LOAD	10	10 (100%)		
SMALL-APPLIANCE	3		UP TO 10 KVA	23.3	9.32 (40%)		
LAUNDRY	1.5		OVER 10 KVA	2.28	(220.82(C)(4))		
APPLIANCES	16.1		MAX HEATING OR COOLING	1.79	(220.82(C)(4))		
ELECTRIC COOKING	8.1		TOTAL LOAD	21.1			
MOTORS	1.2		BALANCED LOAD	101 A			
TOTAL GENERAL LOAD			33.3				
PHASE A			99.8%				
PHASE B			100%				

NO.	DATE	DESCRIPTION

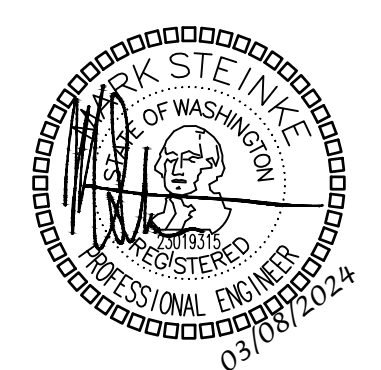

DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: **EAST TOWN CROSSING BUILDING F**
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206-864-3343

ROBISON ENGINEERING, INC.

PERMIT SET
03/08/2024

SHEET TITLE:
PANELS SCHEDULES

SHEET NO.
E.6.01