

EQUIPMENT IDENTIFICATION

Table with 2 columns: Abbreviation and Description. Includes items like AB-# AIR BLENDER, AC# AIR COMPRESSOR, ACU# AIR CONDITIONING UNIT, etc.

ABBREVIATIONS




Table with 2 columns: Abbreviation and Description. Includes items like ADA AIR CONDITIONING UNIT, ADJ ADJUSTABLE, ADI AMERICANS WITH DISABILITIES ACT, etc.

WORK DEFINITION

Table with 2 columns: Symbol and Description. Includes symbols for NEW WORK (N), EXISTING (E), REMOVE EXISTING (D), etc.

(HVAC)

NOTE: ALL DUCT SIZES ARE INTERIOR, FREE DIMENSIONS ALWAYS WIDTH (HORIZONTAL DIM.) x HEIGHT (VERTICAL DIM.)

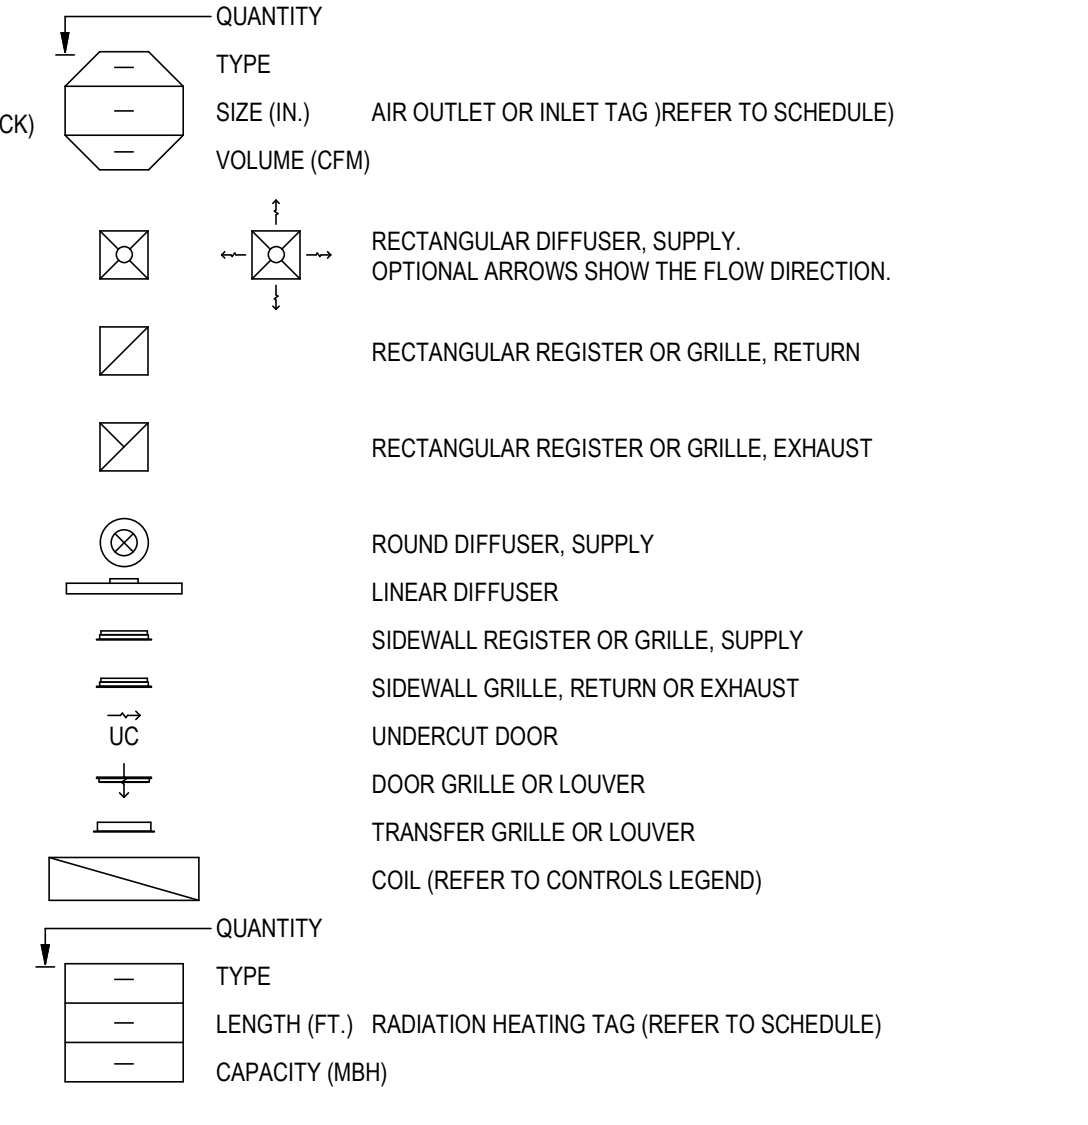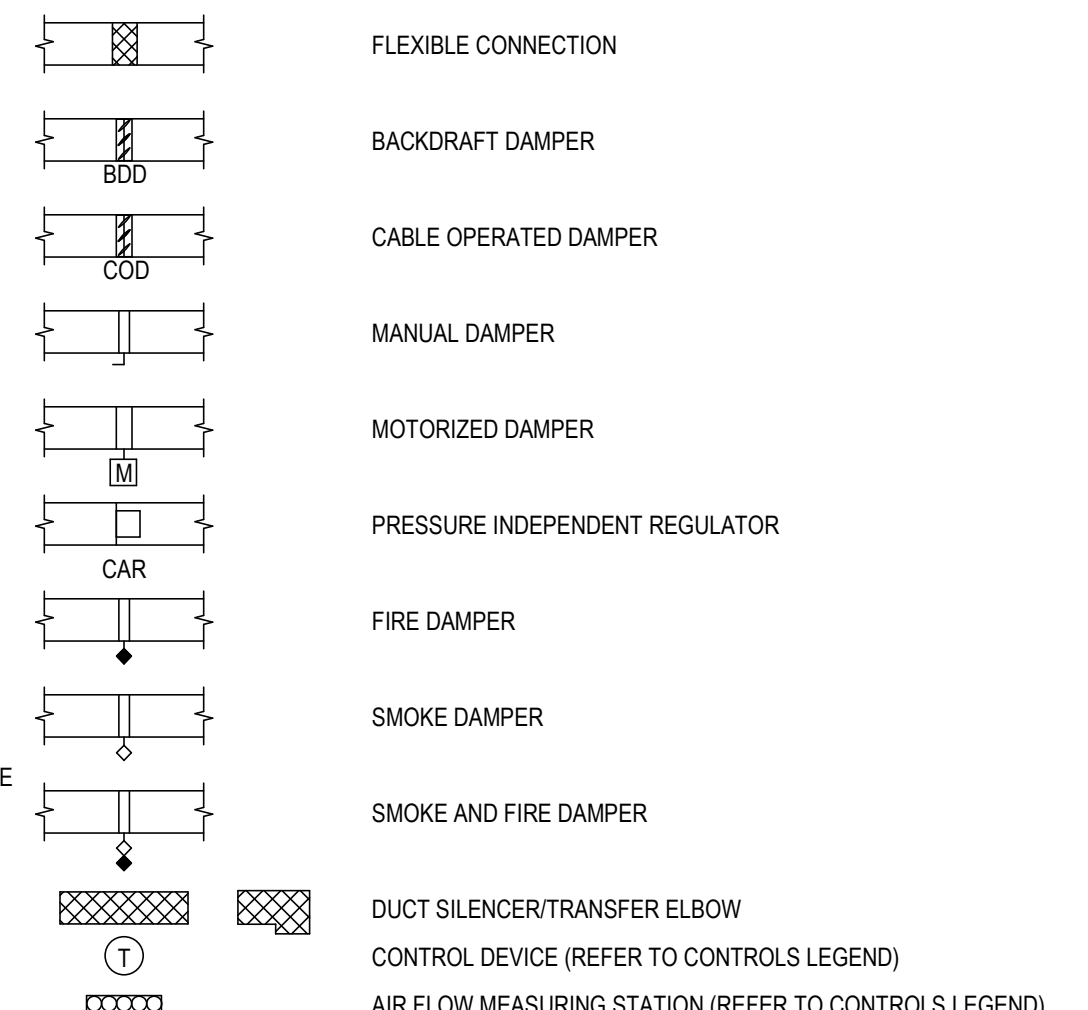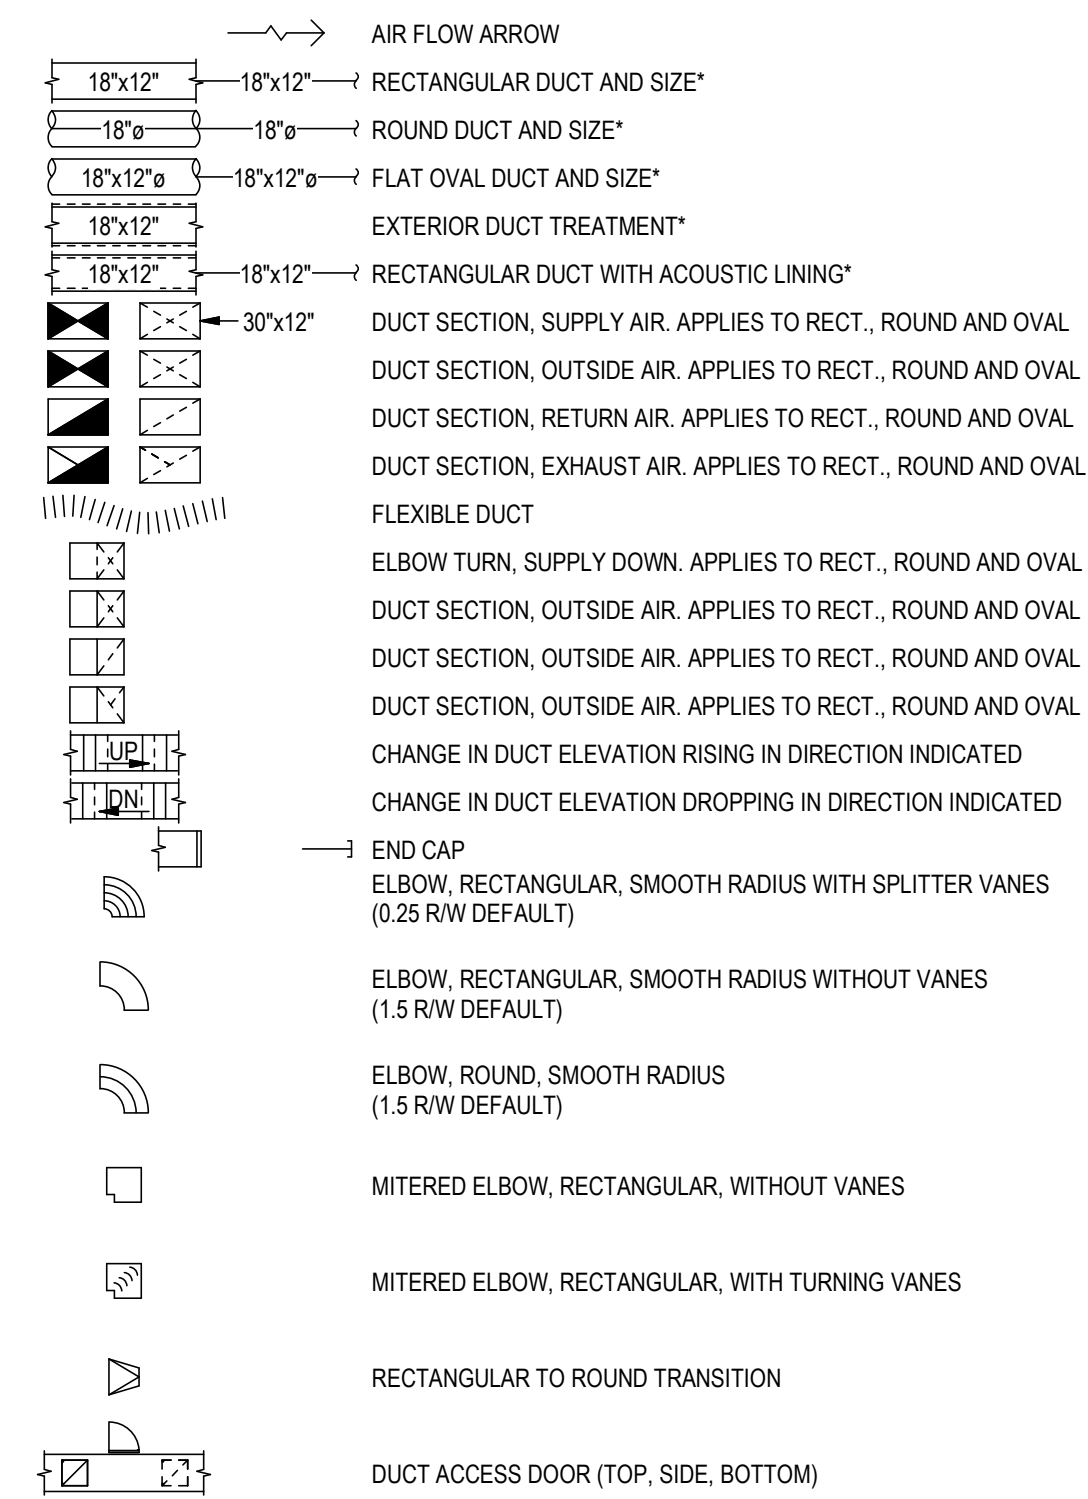

PIPING SYSTEMS (HVAC)

Table with 2 columns: Symbol and Description. Lists HVAC piping symbols such as BBD BOILER BLOWDOWN, BFW BOILER FEED WATER, BR BRINE RETURN, etc.

PIPING SYSTEMS

Table with 2 columns: Symbol and Description. Lists general piping symbols such as 2 1/2" PIPE SIZE, PIPING ROUTED BELOW SLAB OR GRADE, ACID DENT, etc.

PIPING SYSTEMS

Table with 2 columns: Symbol and Description. Lists general piping symbols such as WAGD ANESTHETIC EVACUATION, CO2 CARBON DIOXIDE, DA DENTAL COMPRESSED AIR, etc.

PLUMBING SYSTEMS

Table with 2 columns: Symbol and Description. Lists plumbing symbols such as 2 1/2" PIPE SIZE, PIPING ROUTED BELOW SLAB OR GRADE, ACID DENT, etc.

LAB & MEDICAL GAS

Table with 2 columns: Symbol and Description. Lists lab and medical gas symbols such as WAGD ANESTHETIC EVACUATION, CO2 CARBON DIOXIDE, DA DENTAL COMPRESSED AIR, etc.

FIRE PROTECTION

Table with 2 columns: Symbol and Description. Lists fire protection symbols such as F(AF) FIRE - ANTI-FREEZE, F(CA) FIRE - CLEAN AGENT, F(DEL) FIRE - DELUGE, etc.

CONTROLS

Table with 2 columns: Symbol and Description. Lists control symbols such as UNITARY HEATING COIL, UNITARY COOLING COIL, UNITARY HEAT RECOVERY COIL, FILTER, AIR BLENDER, ENERGY WHEEL, etc.

CONTROLS

Table with 2 columns: Symbol and Description. Lists control symbols such as AIR PRESSURE GAUGE, AIR SAMPLING POINT, CARBON DIOXIDE SENSOR, CARBON MONOXIDE SENSOR, COMBUSTIBLE GAS SENSOR, etc.

DRAWING INDEX

Table with 2 columns: Drawing Number and Description. Lists drawings like M500 MECHANICAL SWITCHGEAR LEGEND AND ABBREVIATIONS, M501 MECHANICAL SWITCHGEAR GENERAL NOTES AND SCHEDULES, M502 SWITCHGEAR MECHANICAL ENLARGED PLAN.

City of Puyallup Building Reviewed for Compliance stamp. Includes date 05/10/2024 and time 1:01:53 PM. Also includes City of Puyallup Development & Permitting Services ISSUED PERMIT stamp with Building, Planning, Engineering, and Public Works signatures.

THE APPROVED CONSTRUCTION PLANS AND ALL ENGINEERING MUST BE POSTED ON THE JOB AT ALL INSPECTIONS IN A VISIBLE AND READILY ACCESSIBLE LOCATION. PRINT IN COLOR AND TO SCALE.

Approval of submitted plans is not an approval of omissions or oversight by this office or noncompliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable building codes and regulations of the local government.

See separate architectural plans.


NOTE: NOT ALL SYMBOLS, SYSTEMS, AND ABBREVIATIONS MAY BE USED ON THIS PROJECT

MECHANICAL DRAWINGS

CENTERS
VOLTAGE PARK UPS
1019 39th AVENUE SE
PUYALLUP, WA 98374



Revision No. Description Date

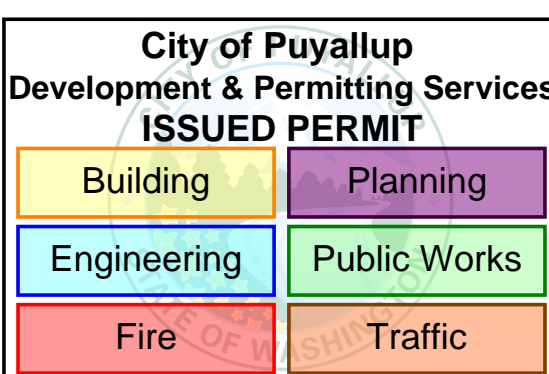

Drawn By: JLV Checked By: BO

MECHANICAL SWITCHGEAR GENERAL NOTES AND SCHEDULES

M501

Sheet

GENERAL NOTES

- THE MECHANICAL PLANS ARE DIAGRAMMATIC IN NATURE AND ARE BASED ON ONE MANUFACTURER'S EQUIPMENT. THEY ARE NOT INTENDED TO SHOW EVERY ITEM IN ITS EXACT LOCATION, THE EXACT DIMENSIONS, OR ALL OF THE DETAILS FOR THE EQUIPMENT. THE MECHANICAL CONTRACTOR SHALL VERIFY THE ACTUAL DIMENSIONS OF THE EQUIPMENT AND ENSURE THAT IT WILL FIT IN THE AVAILABLE SPACE.
- MECHANICAL CONTRACTOR RESPONSIBLE FOR INSTALLATION OF COMPLETED AND OPERATIONAL SYSTEMS WITH DUE RESPECT TO ALL APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION.
- IT IS THE CONTRACTOR RESPONSIBILITY TO FIELD VERIFY ALL CONNECTION POINTS PRIOR TO INSTALL. NOT ALL CONNECTION SIZES ARE SHOWN, BUT THOSE THAT ARE APPROXIMATE AND TAKEN FROM EXISTING AS-BUILTS AND FIELD OBSERVATIONS.
- COORDINATE PIPE ROUTING WITH DUCTWORK, SPRINKLER PIPING AND ELECTRICAL POWER/LIGHTING CIRCUITING AND STRUCTURAL MEMBERS PRIOR TO INSTALLATION.
- CONTRACTORS TO VERIFY ALL GRADES, DIMENSIONS AND EXISTING CONDITIONS AT THE SITE BEFORE PROCEEDING WITH WORK. NOTIFY PRIME CONSULTANT OF ANY DISCREPANCIES BETWEEN DRAWINGS AND ACTUAL CONDITIONS BEFORE INSTALLATION.
- EQUIPMENT AND SYSTEMS SHALL COMPLY WITH 2018 WASHINGTON STATE ENERGY AND MECHANICAL CODES.
- COORDINATE INSTALLATION OF PIPING AND DUCTWORK WITH ELECTRICAL CONTRACTOR AND OTHER TRADES.
- CONTRACTOR IS RESPONSIBLE FOR ALL PERMITS NEEDED TO CONSTRUCT WORK SHOULD IN THE CONSTRUCTION DOCUMENTS AND ACCOMPANYING SPECIFICATIONS.
- IF THERE IS A CONFLICT BETWEEN THE CONSTRUCTION DOCUMENTS AND SPECIFICATIONS, THE MOST STRINGENT WILL APPLY.
- ALL EQUIPMENT SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE EQUIPMENT MANUFACTURERS. CONTRACTOR TO PROVIDE ALL FITTINGS, TRANSITIONS, DAMPERS, VALVES, AND OTHER DEVICES REQUIRED FOR A COMPLETE WORKABLE INSTALLATION.
- SYSTEMS ADHERE TO 2018 WSEC SECTION C403.2.3 VARIABLE FLOW CAPACITY. FOR FAN AND PUMP MOTORS 7.5 HP AND GREATER, INCLUDING MOTORS IN OR SERVING CUSTOM AND PACKAGED AIR HANDLERS SERVING VARIABLE AIR VOLUME SYSTEMS, CONSTANT VOLUME FANS, HEATING AND COOLING HYDRONIC PUMPING SYSTEMS, AND OTHER PUMP OR FAN MOTORS WHERE VARIABLE FLOWS ARE REQUIRED SHALL BE EQUIPPED WITH VARIABLE SPEED DRIVES.
- SYSTEMS ADHERE TO SECTION C403.3.2 HVAC EQUIPMENT PERFORMANCE REQUIREMENTS. EQUIPMENT SHALL MEET THE MINIMUM EFFICIENCY REQUIREMENTS OF TABLES C403.3.2(1) THROUGH C403.3.2(2) WHEN TESTED AND RATED IN ACCORDANCE WITH THE APPLICABLE TEST PROCEDURE.
- SYSTEMS ADHERE TO C406.8 ELECTRIC MOTOR EFFICIENCY:
 - ALL ELECTRIC MOTORS, FRACTIONAL OR OTHERWISE, SHALL MEET THE MINIMUM EFFICIENCY REQUIREMENTS OF TABLES C406.8(1) THROUGH C406.8(4) WHEN TESTED IN ACCORDANCE WITH DOE 10 CFR UNLESS OTHER EXCEPTIONS ARE QUALIFIED AND MET BY THIS SECTION.
 - FRACTIONAL HP FAN MOTORS THAT ARE 1/2 HP OR GREATER AND LESS THAN 1 HP (BASED ON THE OUTPUT POWER) WHICH ARE NOT COVERED IN TABLES C406.8(3) AND C406.8(4) SHALL BE ELECTRONICALLY COMMUTATED MOTORS OR SHALL HAVE A MINIMUM MOTOR EFFICIENCY OF 70 PERCENT WHEN RATED IN ACCORDANCE WITH DOE 10 CFR 431.
- PENETRATIONS OF DUCTS, PIPES, CONDUITS, ETC IN WALLS REQUIRING PROTECTED OPENINGS SHALL BE FIRE STOPPED. FIRE STOP MATERIAL SHALL BE A UL-LISTED ASSEMBLY APPROPRIATE FOR FIRE OR SMOKE PENETRATIONS AS APPLICABLE AND AS APPROVED BY THE FIRE MARSHAL.
- THE MECHANICAL CONTRACTOR SHALL PROVIDE AND INSTALL FIRE, SMOKE, OR COMBINATION SMOKE/FIRE DAMPERS AND ACCESS PANELS COMMENSURATE WITH THE RATING OF THE WALL IN ALL DUCTWORK THAT PENETRATES FIRE WALLS, FIRE BARRIERS, FIRE PARTITIONS, SMOKE BARRIERS AND SMOKE PARTITION IN ALL DUCTWORK THAT PENETRATES A HORIZONTAL OR VERTICAL FIRE PARTITION, OR AS OTHERWISE SHOWN ON THE DRAWINGS.
- ALL BRANCH DUCTS SHALL HAVE VOLUME DAMPERS.
- WHERE FLOW EXCEEDS 150 CFM, THE CONTRACTOR SHALL USE SMOOTH RADIUS ELBOWS OR TURNING VANES.
- ALL DUCT JOINTS SHALL BE SEALED IN ACCORDANCE WITH SMACNA STANDARDS.
- ALL DUCT DIMENSIONS ARE NET INSIDE VALUES. DIMENSIONS MAY BE CHANGED PROVIDED THAT THE NET FREE AREA IS MAINTAINED.
- ALL CONCEALED DUCTWORK SHALL BE INSULATED WITH 1" FIBERGLASS INSULATING BLANKET WITH ALUMINUM FOIL FACING.
- ALL DUCTWORK SHALL BE CONSTRUCTED, ERECTED AND TESTED IN ACCORDANCE WITH THE LOCAL REGULATIONS AND PROCEDURES DETAILED IN THE APPLICABLE STANDARDS ADOPTED BY THE SHEET METAL AND AIR CONDITIONING CONTRACTORS NATIONAL ASSOCIATION, (SMACNA).
- ALL DUCTWORK SHALL BE CONSTRUCTED AND SEALED PER IMC.
- DUCTWORK SHALL MEET THE AIR LEAKAGE REQUIREMENTS OF 2018 WSEC C402.5 AND VAPOR RETARDER REQUIREMENTS PER THE IBC.
- ALL PIPE SHALL BE SUPPORTED FROM THE BUILDING STRUCTURE IN A NEAT AND WORKMANLIKE MANNER. THE USE OF WIRE OR METAL STRAPS TO SUPPORT PIPES WILL NOT BE PERMITTED. REFER TO SPECIFICATIONS FOR MINIMUM SPACING OF PIPE SUPPORTS.
- ALL EQUIPMENT TO BE INSTALLED ON MIN 6" THICK CONCRETE HOUSEKEEPING PADS.
- ALL EQUIPMENT, DUCTS PIPING, AND OTHER DEVICES AND MATERIALS INSTALLED OUTSIDE OF THE BUILDING OR OTHERWISE EXPOSED TO THE WEATHER SHALL BE COMPLETELY WEATHERPROOFED.
- MECHANICAL EQUIPMENT, DUCTS AND PIPING ARE TO BE COORDINATED WITH STRUCTURAL JOISTS AND CROSS BRACING.
- ALL EXPOSED PIPING IN OCCUPIED SPACES SUBJECT TO ARCHITECTURAL APPROVAL PRIOR TO INSTALLATION.
- ALL DUCTWORK SHALL BE CONSTRUCTED AND SEALED PER IMC.
- DUCTWORK SHALL MEET THE AIR LEAKAGE REQUIREMENTS OF 2018 WSEC C402.5 AND VAPOR RETARDER REQUIREMENTS PER THE IBC.
- THE HVAC SYSTEMS SHALL BE TESTED AND BALANCED BY AN INDEPENDENT AGENCY, UNDER THE SUPERVISION OF A LICENSED PROFESSIONAL ENGINEER PRIOR TO COMMISSIONING. A SEALED TYPE WRITTEN REPORT SHALL BE SUBMITTED TO THE ARCHITECT/ENGINEER.
- A BUILDING COMMISSIONING PROCESS AND FUNCTIONAL TESTING OF MECHANICAL SYSTEMS SHALL BE CARRIED OUT BY A CERTIFIED COMMISSIONING PROFESSIONAL IN ACCORDANCE WITH 2018 WSEC SECTION C408. THE MECHANICAL, ELECTRICAL, PLUMBING, AND CONTROL CONTRACTORS ARE REQUIRED TO PERFORM FUNCTIONAL PERFORMANCE TESTING OF ALL EQUIPMENT PRIOR TO TESTING BY THE COMMISSIONING AGENT. CONTRACTORS SHALL PROVIDE THE NECESSARY ASSISTANCE TO THE COMMISSIONING AGENT TO PERFORM COMMISSIONING DUTIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR TAKING CORRECTIVE ACTION IF ANY DEFICIENCIES ARE FOUND DURING COMMISSIONING.
- SYSTEMS ADHERE TO 2018 WSEC SECTION C408 SYSTEM COMMISSIONING:
 - A CERTIFIED COMMISSIONING PROFESSIONAL (CCP) SHALL LEAD THE COMMISSIONING PROCESS. A CCP IS AN INDIVIDUAL WHO IS CERTIFIED BY AN ANSI/ISO/IEC 17024:2012 ACCREDITED ORGANIZATION TO LEAD, PLAN, COORDINATE, AND MANAGE COMMISSIONING TEAMS AND IMPLEMENT THE COMMISSIONING PROCESS.
 - A CERTIFIED COMMISSIONING PROFESSIONAL SHALL PERFORM THE FOLLOWING:
 - DEVELOP A COMMISSIONING PLAN.
 - REVIEW BUILDING DOCUMENTATION AND CLOSE-OUT SUBMITTALS.
 - PROVIDE A COMMISSIONING REPORT.
 - LIST SPECIFIC EQUIPMENT, APPLIANCES AND SYSTEMS COMMISSIONED.
 - FUNCTIONAL TESTING SHALL BE COMPLETED FOR THE FOLLOWING SYSTEMS AND THEIR ASSOCIATED CONTROL SYSTEMS:
 - MECHANICAL SYSTEMS
 - SERVICE WATER HEATING SYSTEMS
 - CONTROLLED RECEPTACLE AND LIGHTING SYSTEMS
 - EQUIPMENT APPLIANCE AND SYSTEMS
 - ENERGY METERING
 - REFRIGERATION SYSTEMS
 - A COMMISSIONING REPORT SHALL BE DELIVERED TO THE BUILDING OWNER AND INCLUDE:
 - RESULTS OF THE FUNCTIONAL PERFORMANCE TESTS
 - LIST OF DEFICIENCIES AND CORRECTIVE MEASURES IMPLEMENTED OR PROPOSED.
 - FUNCTIONAL PERFORMANCE TEST PROCEDURES.
 - COMMISSIONING PLAN.
 - TAB REPORT.
- TESTING AND BALANCING: ALL HVAC SYSTEMS SHALL BE BALANCED BY A LICENSED CONTRACTOR IN ACCORDANCE WITH ACCEPTED ENGINEERING STANDARDS AND SPECIFICATIONS PRIOR TO COMMISSIONING.
- OWNER TRAINING BY CONTRACTORS FOR EACH PIECE OF EQUIPMENT OR SYSTEM SHALL INCLUDE: SYSTEM/EQUIPMENT OVERVIEW (WHAT IT IS, WHAT IT DOES, AND WHICH OTHER SYSTEMS OR EQUIPMENT DOES IT INTERFACE WITH), REVIEW OF THE AVAILABLE O&M MATERIALS, REVIEW OF THE RECORD DRAWINGS ON THE SUBJECT SYSTEM/EQUIPMENT, HANDSON DEMONSTRATION OF ALL NORMAL MAINTENANCE PROCEDURES, NORMAL OPERATING MODES, AND ALL EMERGENCY SHUTDOWN AND START-UP PROCEDURES.

FAN SCHEDULE																
UNIT IDENTIFICATION			MAX AIRFLOW (CFM)	ESP (IN-WG)	FAN WHEEL		FAN MOTOR			ELECTRICAL		OPERATING WEIGHT (LBS.)	MANUFACTURER	MODEL NUMBER	NOTES	
MARK	NUMBER	UNIT/AREA SERVED			TYPE	SPEED (RPM)	BHP	HP	SPEED (RPM)	DRIVE TYPE	VOLTS					PHASE
TF	1	SWITCHGEAR ROOM	200	0.25	INLINE	1,276	0.1	1/6	1,276	DIRECT	120	1	80	GREENHECK	BSQ-90	1

NOTES:
1. PROVIDE WITH SPEED CONTROLLER, BACKDRAFT DAMPER.


ELECTRIC UNIT HEATER SCHEDULE																
UNIT IDENTIFICATION			TYPE	CAPACITY (MBH)	AIR			MOTOR		ELECTRICAL		CONTROL TYPE	OPERATING WEIGHT (LBS.)	MANUFACTURER	MODEL NUMBER	NOTES
MARK	NUMBER	ROOM SERVED			AIRFLOW (CFM)	KW	SPEED (RPM)	STAGES	VOLTS	PHASE						
LH	1	SWITCHGEAR	WALL MOUNT	10.0	310	3.0	1,490	1	208	1	UNIT MOUNTED FAN...	40	REZDOR	EGEB-3	1	

NOTES:
1. PROVIDE 3KW HEATER FOR FREEZE PROTECTION IN SEMI-HEATED SWITCHGEAR ENCLOSURE AND INTEGRAL UNIT-MOUNTED THERMOSTAT.

LOUVER SCHEDULE										
UNIT IDENTIFICATION			TYPE	MAX APD...	BLADE TYPE	NET FREE AREA (SF)	SIZE (")	MANUFACTURER	MODEL NUMBER	NOTES
MARK	NUMBER	SYSTEM SERVED								
LVR	1	SWITCHGEAR ROOM	STATIONARY	0.3	HORIZONTAL DRAINABLE	1.94	24X24	RUSKIN	ELF375	
LVR	2	SWITCHGEAR ROOM	STATIONARY	0.3	HORIZONTAL DRAINABLE	1.94	28X28	RUSKIN	ELF375	

MECHANICAL
DRAWINGS

CENTERIS
VOLTAGE PARK UPS
1019 39th AVENUE SE
PUYALLUP, WA 98374

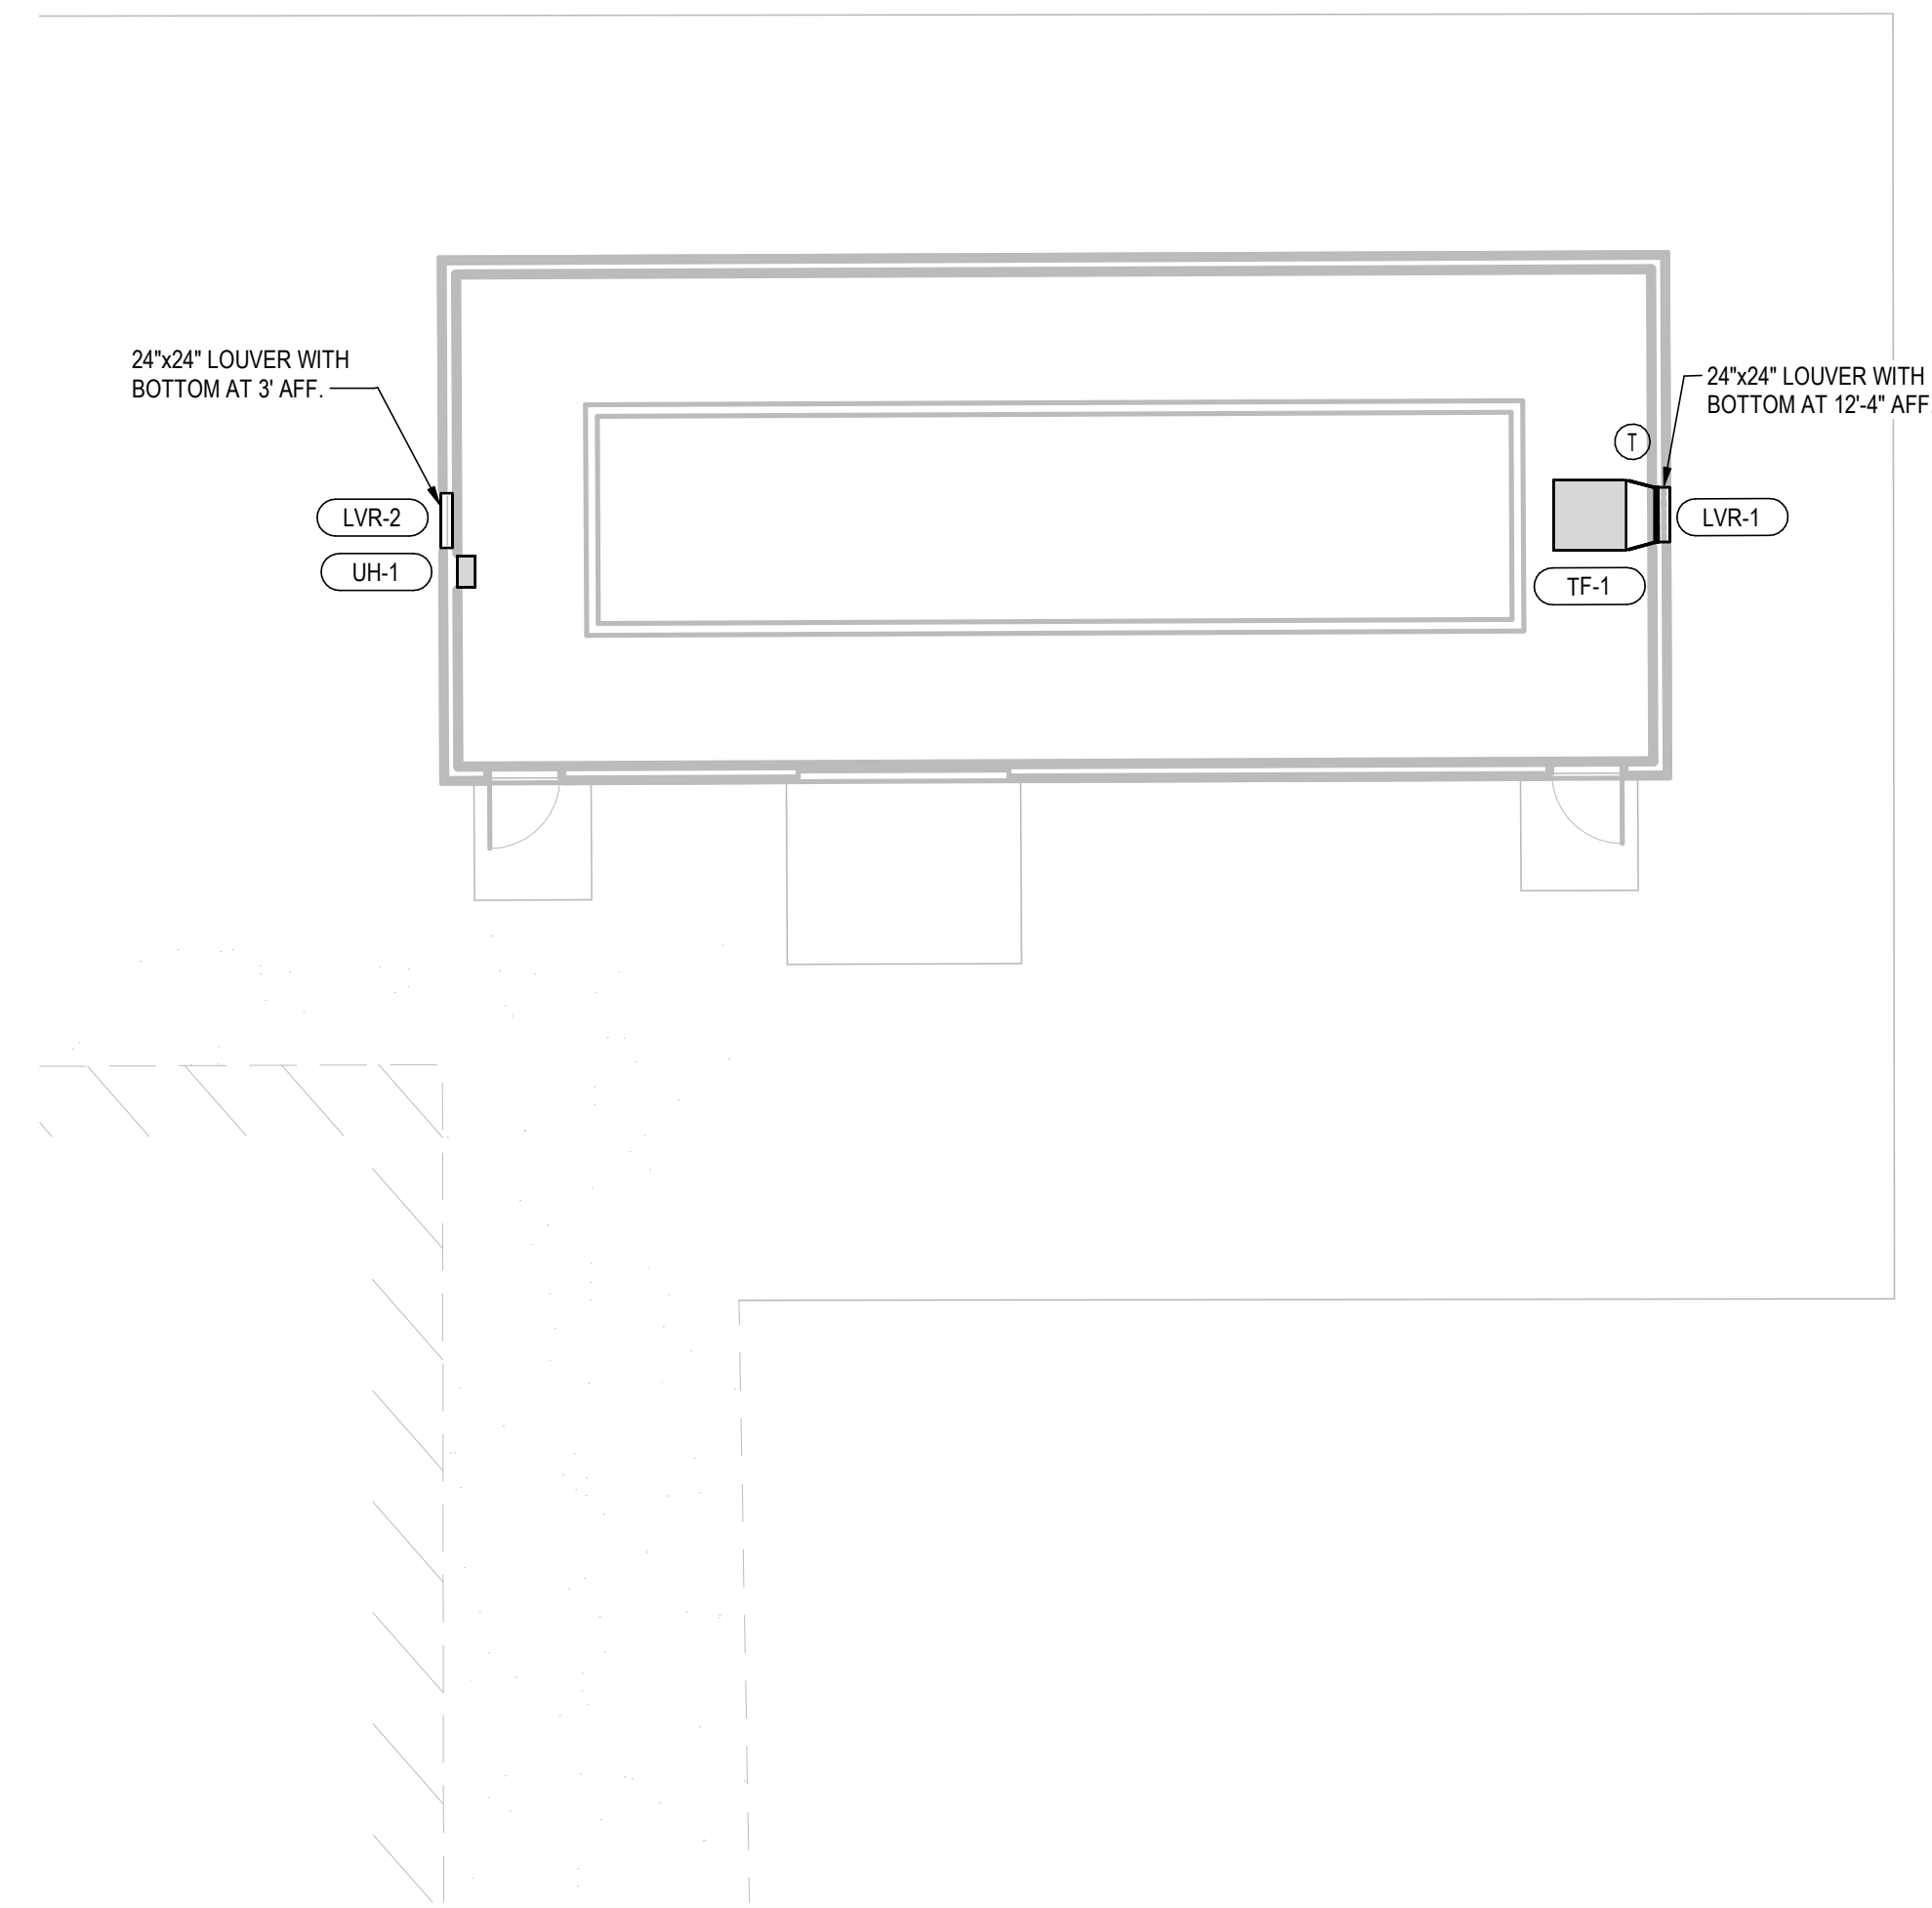

1 MECHANICAL SWITCHGEAR ENLARGED PLAN
M502 1/8" = 1'-0"

Revision No. Description Date

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building	Planning
Engineering	Public Works
Fire	Traffic

Drawn By: JLV Checked By: BO

SWITCHGEAR
MECHANICAL
ENLARGED PLAN

Sheet M502