

**SURVEYOR**

ABBEY ROAD GROUP  
CONTACT: LARRY WALKER  
PO BOX 1224  
PUYALLUP, WA 98371  
OFFICE: 253-435-3699

**ARCHITECT**

SYNTHESIS 9, LLC  
CONTACT: BRETT LINDSAY  
223 N. D. ST  
TACOMA, WA 98403  
OFFICE: 253-468-4117

**CIVIL ENGINEER**

AHBL INC.  
2215 NORTH 30TH STREET, SUITE 300  
TACOMA, WA 98403  
PHONE: (253) 383-2422  
CONTACT: TODD SAWIN  
EMAIL: TSAWIN@AHBL.COM

**SITE INFORMATION**

PARCEL: 0420264021, 0420264054, 0420264053, 0420351066, 0420351030, 0420351029, 0420351026  
ADDRESS: 2902 E PIONEER  
PUYALLUP, WA 98372  
ZONING: CG AND RM-20

**SURVEYOR'S NOTES**

- 1. HORIZONTAL DATUM: BASIS OF BEARING AND SURVEY DATA PER WASHINGTON STATE PLANE COORDINATE SYSTEM, SOUTH ZONE.
2. BASIS OF BEARING: HELD S 01° 21' 28" W OBSERVED ALONG THE EAST LINE OF THE NORTHEAST QUARTER OF SEC. 35, T. 20 N. R. 4 E. BETWEEN THE NORTHEAST CORNER OF THE NORTHEAST QUARTER MONUMENT AND THE SOUTHWEST CORNER OF THE NORTHEAST QUARTER MONUMENT OF THE SAID SECTION AS SHOWN HEREON.
3. VERTICAL DATUM: NAVD88
AS DEFINED BY THE NATIONAL GEODETIC SURVEY (NGS)
PROJECT BENCHMARK: DESIGNATION: 21 010 PID: DL2774
PUBLISHED ELEVATION: 75.70 FEET (NAVD 88)
DESCRIPTION: ENCASED STEEL ROD LOCATED IN EASTERLY GRAVEL SHOULDER AT THE INTERSECTION OF PIONEER WAY AND 134TH AVE.
4. ALL UTILITY LOCATES HAVE BEEN DETERMINED BY SURFACE LOCATION ONLY EITHER BY PHYSICAL STRUCTURES OR PAINT MARKINGS
AS DETERMINED BY UNDERGROUND - UTILITY LOCATE, INC. AND/OR UTILITY COMPANY. GAS PIPE LOCATION WITHIN THE PROPERTY DETERMINED BY MAP PROVIDED BY PUGET SOUND ENERGY, INC. ACTUAL UNDERGROUND LOCATION MAY VARY. EXISTING UTILITIES AS SHOWN MAY NOT BE THE SAME AFTER THIS DATE AS MAJOR CONSTRUCTION IS IN PROGRESS.
5. REFERENCE SURVEYS:
1. 200303315001
2. SP 9303315001
3. ROS 8210040207
6. METHOD OF SURVEYING WAS:
1. CONVENTIONAL TRAVERSE USING A TOPCON 800A TOTAL STATION.
2. MONUMENTS FOUND MARCH 2008

**TOPOGRAPHIC NOTE**

THE EXISTING CULTURAL AND TOPOGRAPHICAL DATA SHOWN ON THESE DRAWINGS HAS BEEN PREPARED, IN PART, BASED UPON INFORMATION FURNISHED BY OTHERS. WHILE THIS INFORMATION IS BELIEVED TO BE RELIABLE, AHBL ENGINEERING CANNOT ENSURE ACCURACY AND THIS IS NOT RESPONSIBLE FOR THE ACCURACY OF THAT INFORMATION OR FOR ANY ERRORS OR OMISSIONS WHICH MAY HAVE BEEN INCORPORATED INTO THESE DRAWINGS AS A RESULT.

**FILL SPECIFICATIONS**

FILL MATERIAL SHALL NOT CONTAIN PETROLEUM PRODUCTS, OR SUBSTANCES WHICH ARE HAZARDOUS, DANGEROUS, TOXIC, OR WHICH OTHERWISE VIOLATE ANY STATE, FEDERAL, OR LOCAL LAW, ORDINANCE, CODE, REGULATION, RULE, ORDER, OR STANDARD.

**FIRE SPRINKLER NOTE**

FIRE LINE SHALL BE SIZED BY A LICENSED FIRE PROTECTION ENGINEER. A SEPARATE, DETAILED PLAN SHALL BE APPROVED BY THE FIRE MARSHALL AND INSTALLED BY A WASHINGTON CERTIFIED LEVEL "U" CONTRACTOR IN ACCORDANCE WITH WAC 216-09-010. A POST INDICATOR VALVE SHALL BE INSTALLED ON THE SPRINKLER LINE TO ISOLATE THE FIRE SYSTEM FROM THE WATER SYSTEM WHEN REQUIRED.

**VERIFICATION NOTE**

ALL EXISTING UTILITIES IN THE CONSTRUCTION AREA SHALL BE IDENTIFIED AND VERIFIED FOR DEPTH AND LOCATION PRIOR TO ANY CONSTRUCTION ACTIVITIES SO TO IDENTIFY ANY POTENTIAL CONFLICTS WITH PROPOSED CONSTRUCTION. CONTACT PROJECT ENGINEER IMMEDIATELY IF ANY CONFLICTS ARE IDENTIFIED.

PRIOR TO ANY CONSTRUCTION ACTIVITIES, VERIFY EXISTING TOPOGRAPHY IS CONSISTENT WITH WHAT IS SHOWN ON PLANS AND IF THERE ARE ANY POTENTIAL CONFLICTS WITH PROPOSED CONSTRUCTION ACTIVITIES, CONTACT PROJECT ENGINEER IMMEDIATELY IF ANY CONFLICTS ARE IDENTIFIED.

**TRENCH NOTES**

IF WORKERS ENTER ANY TRENCH OR OTHER EXCAVATION FOUR OR MORE FEET IN DEPTH THAT DOES NOT MEET THE OPEN PIT REQUIREMENTS OF WSDOT SECTION 2-09.30(3), IT SHALL BE SHORED AND CRIBBED. THE CONTRACTOR IS ALONE RESPONSIBLE FOR WORKER SAFETY. ALL TRENCH SAFETY SYSTEMS SHALL MEET THE REQUIREMENTS OF THE WASHINGTON INDUSTRIAL SAFETY AND HEALTH ACT, CHAPTER 49.17 RCW.

**CONSTRUCTION SEQUENCE**

- 1. OBTAIN REQUIRED PERMITS AND HOLD A PRE-CONSTRUCTION MEETING WITH THE CITY
2. FLAG CLEARING LIMITS
3. INSTALL OR REPLACE SILT FENCE
4. INSTALL CONSTRUCTION ENTRANCE
5. POT-HOLE ANY EXISTING UTILITIES FOR VERIFICATION OF DEPTH AND LOCATION. SEE VERIFICATION NOTE.
6. SCHEDULE EROSION CONTROL, INSPECTION W/ CITY
7. GRADE SITE
8. MAINTAIN EROSION CONTROL, MEASURE AND RELOCATE SURFACE WATER CONTROLS AS NEEDED IN ACCORDANCE WITH CITY OF PUYALLUP REQUIREMENTS AND NPDES CONSTRUCTION STORMWATER GENERAL PERMIT.
9. COVER ALL AREAS THAT WILL BE UNWORKED FOR MORE THAN FIVE DAYS DURING THE DRY SEASON OR TWO DAYS DURING THE WET SEASON
10. STABILIZE ALL AREAS WITHIN SEVEN DAYS OF REACHING FINAL GRADE
11. INSTALL RETAINS
12. STABILIZE ALL DISTURBED AREAS AND REMOVE BMPs AND EROSION CONTROL MEASURES AS APPROPRIATE
13. ARRANGE FINAL INSPECTION WITH THE CITY



**CUT AND FILL ESTIMATES**

CUT: 2,500 CY
FILL: 45,600 CY
NET IMPORT: 43,100 CY

**CONDITIONS:**

- 1. PRIOR TO PERMIT ISSUANCE, RIGHT-OF-WAY DEDICATION ALONG SHAW ROAD SHALL BE APPROVED AND RECORDED. RIGHT-OF-WAY ALONG EAST PIONEER SHALL BE APPROVED AND RECORDED PRIOR TO ISSUANCE OF PHASE 2 CIVIL PERMIT.
2. PRIOR TO PERMIT ISSUANCE, THE APPLICANT SHALL CLARIFY WHETHER IT IS THE PROJECT'S INTENT TO DEDICATE RIGHT-OF-WAY OR GRANT AN EASEMENT FOR MAINTENANCE AND OPERATION OF THE SHAW ROAD TRAFFIC SIGNAL AND EQUIPMENT.
3. ALL PRIVATE STORM DRAINAGE FACILITIES SHALL BE COVERED BY A MAINTENANCE AGREEMENT PROVIDED BY THE CITY AND RECORDED WITH PIERCE COUNTY. UNDER THIS AGREEMENT, IF THE OWNER FAILS TO PROPERLY MAINTAIN THE FACILITIES, THE CITY, AFTER GIVING THE OWNER NOTICE, MAY PERFORM NECESSARY MAINTENANCE AT THE OWNER'S EXPENSE. PRIOR TO OCCUPANCY, THE AGREEMENT SHALL BE APPROVED AND RECORDED.
4. PRIOR TO OCCUPANCY, A STREET MAINTENANCE COVENANT WILL BE REQUIRED TO ENSURE THAT PAVEMENT MARKINGS LOCATED ON PRIVATE PROPERTY AT THE DRIVE ENTRANCES WILL BE MAINTAINED.
5. AS MENTIONED DURING THE LAND USE APPLICATION (P-21-0034), THE EXISTING STORMWATER FACILITY SERVING THE OFFSITE PROPERTIES SOUTH OF THE PROJECT IS CURRENTLY IN VIOLATION OF NPDES REGULATIONS AND THE PUYALLUP MUNICIPAL CODE DUE TO LACK OF MAINTENANCE, BREACHING OF THE POND BERM, AND PASS-THROUGH OF A REGULATED STREAM THROUGH THE CONTROL STRUCTURE. HOWEVER, THE CITY IS WILLING TO ALLOW THE POND REMEDIATION TO OCCUR DURING PHASE 2, PROVIDED THE REMEDIATION IS ACCOMPLISHED PRIOR TO ANY OCCUPANCY OF PHASE 1 STRUCTURES.

**EAST TOWN CROSSING PHASE 1**  
**SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.**

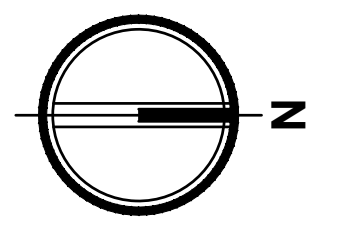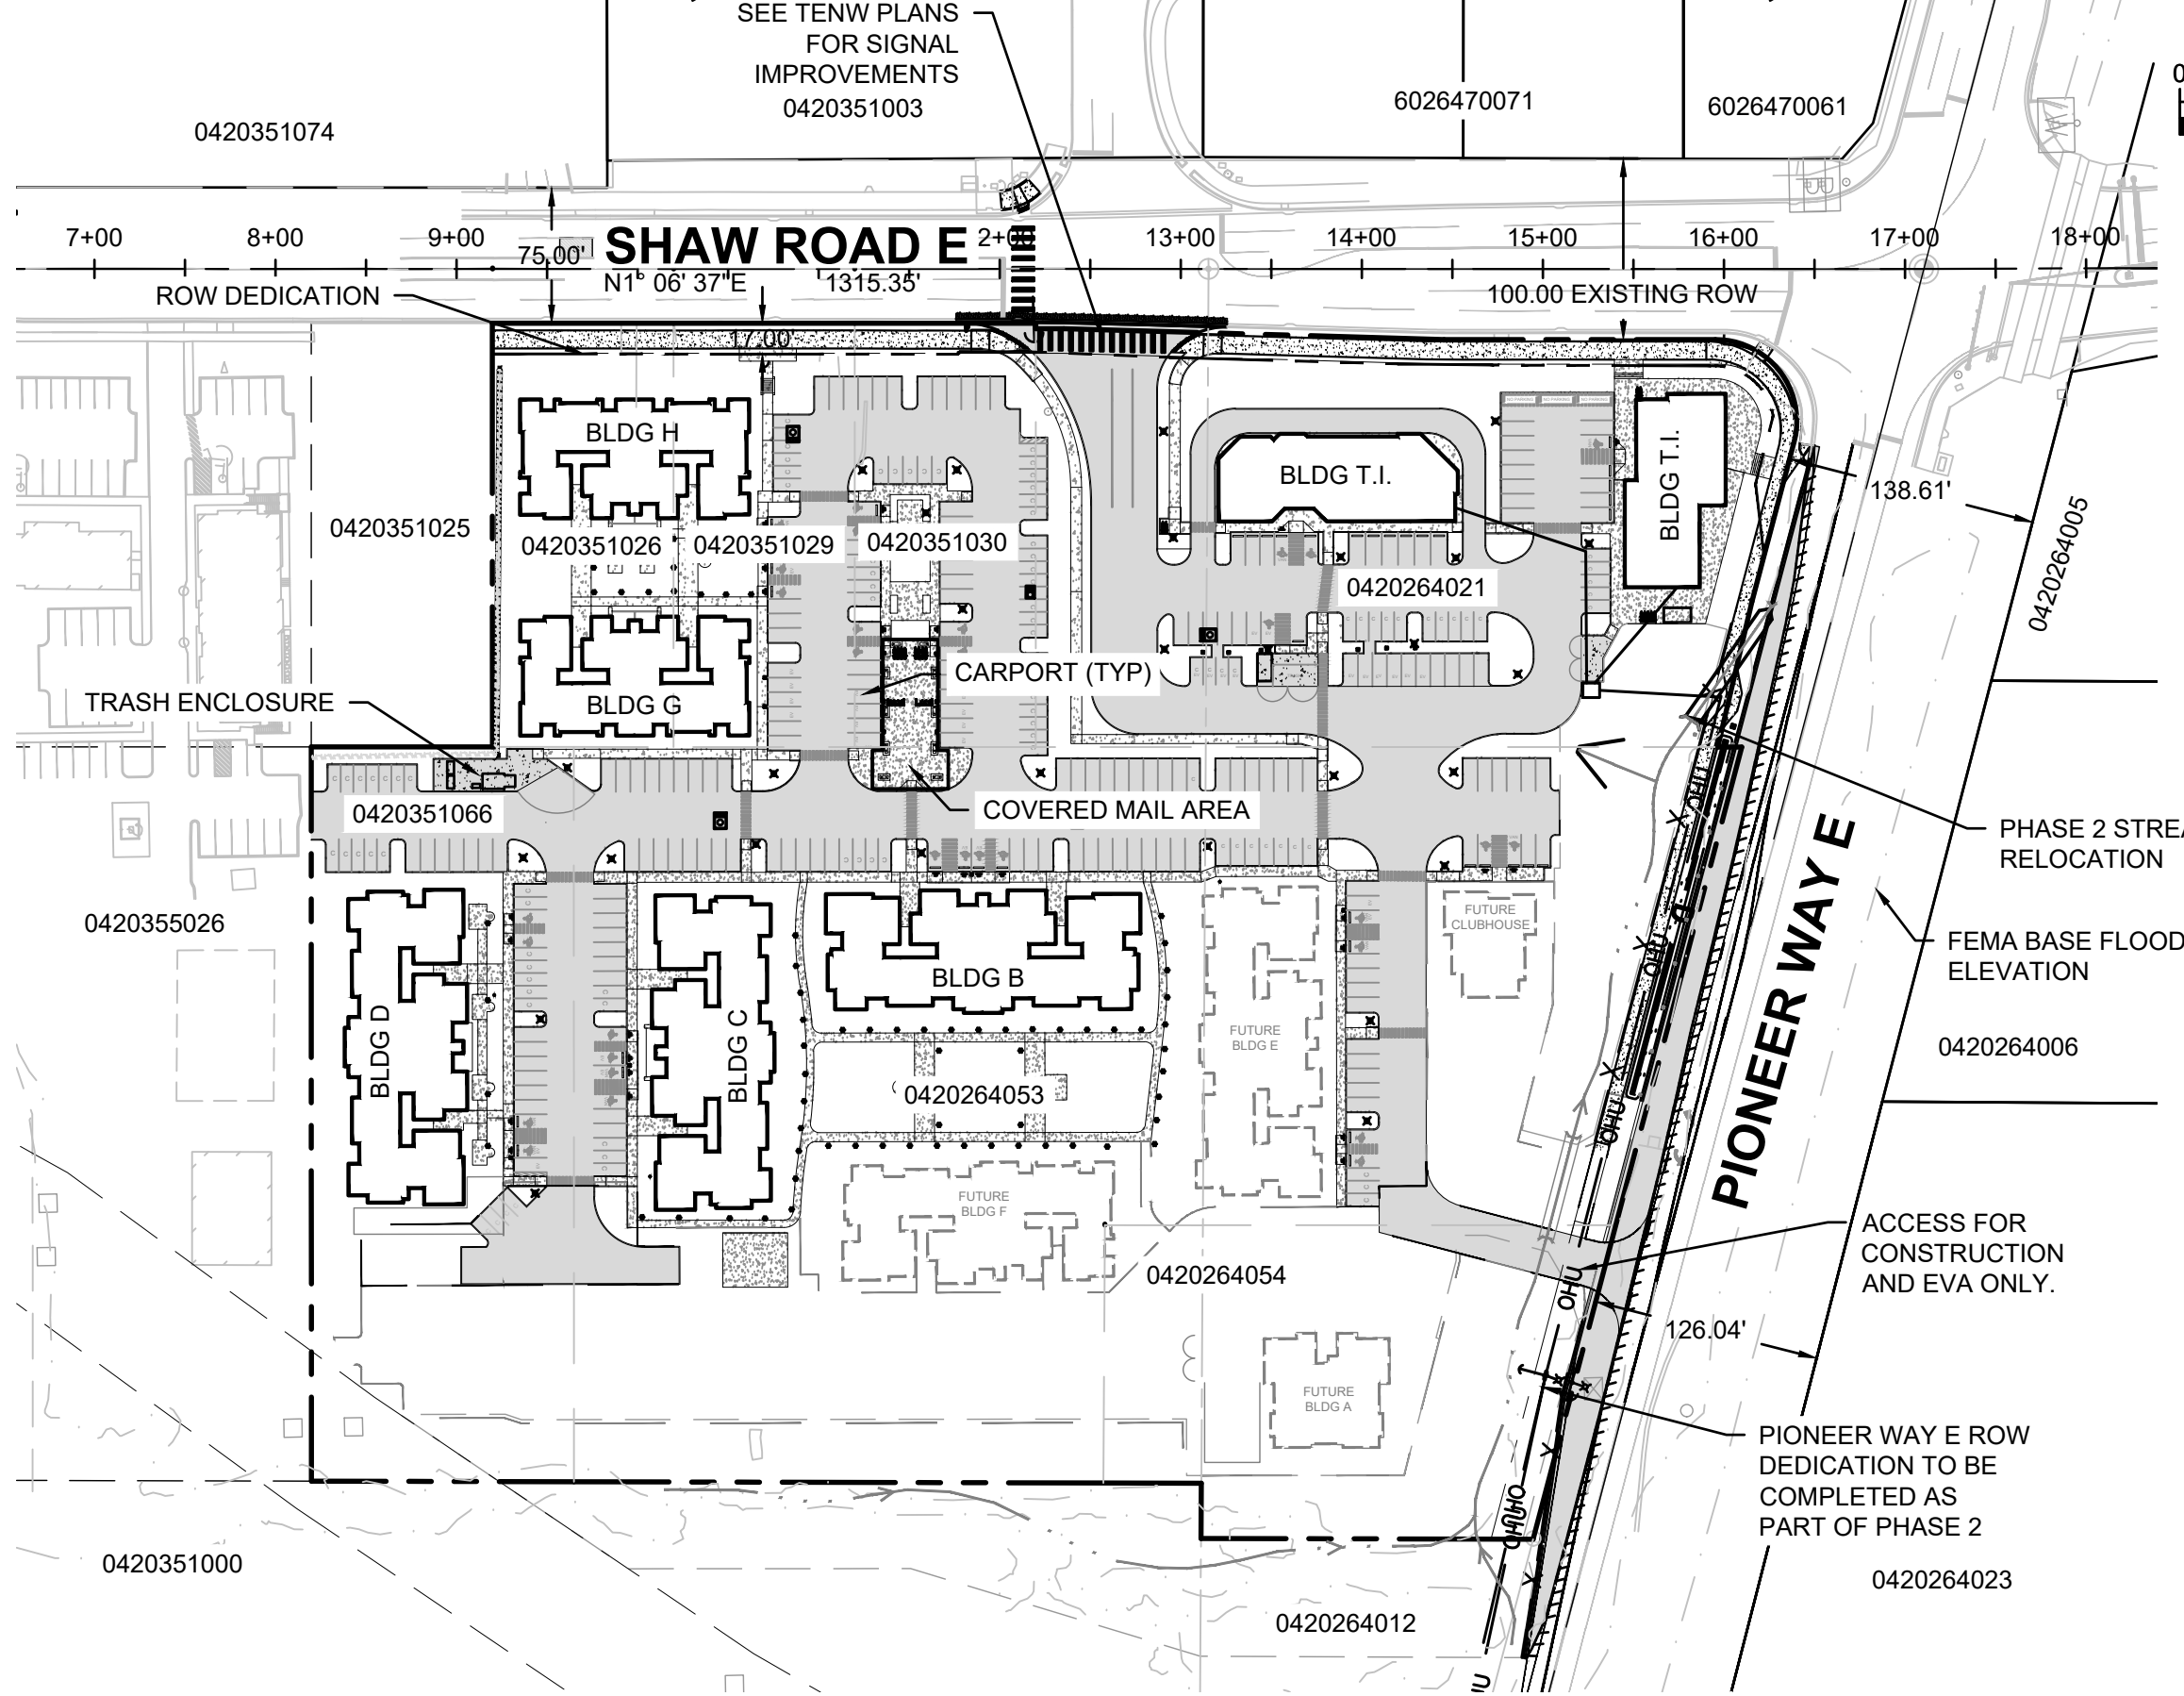

**FLOOD PLAIN NOTE**

THE FLOOD PLAIN INFORMATION SHOWN IN THE PLAN SET IS BASED ON THE REVISED PANEL 342 OF 1375 OF MAP 5303303042E THAT WAS PART OF THE 09/08/22 LOMR. THE FLOOD ZONES AND BEFS SHOWN IN THE PLAN SET ARE DRAWN FROM A COMBINATION OF THE PDF MAP PANEL AND GIS DATA. THE INFORMATION SHOWN IN THE REVISED PANEL IS BASED ON AN ASSUMED RELOCATED STREAM LOCATION. ACTUAL FLOOD ZONE AND BEFs WILL BE BASED FINAL LOCATION AND ELEVATION OF RELOCATED STREAM.

APPROVED

BY: [Signature]  
CITY OF PUYALLUP  
DEVELOPMENT ENGINEERING

DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

**SHEET LIST TABLE**

Table with 2 columns: SHEET # and SHEET TITLE. Lists sheets C0.0 through C4.11, including Cover Sheet, TESC Plan, TESC Notes, Paving Notes, Storm Drainage Plans, Grading Plans, and Utility Plans.

Table with 2 columns: SHEET # and SHEET TITLE. Lists sheets C4.12 through C7.0, including R-Tank Notes and Details, Sewer Plans, Water Plans, and Overall Utility Plan.

**LEGAL DESCRIPTION**

TAX PARCEL NO. 0420264021; PER CW TITLE TITLE RESOURCES GUARANTY COMPANY SUBDIVISION GUARANTEE ORDER NO. 40249905-735 DATED JANUARY 22, 2021 AT 8:00 A.M.

BEGINNING AT THE INTERSECTION OF THE SOUTH LINE OF SECTION 26, TOWNSHIP 20 NORTH, RANGE 4 EAST, W.M., IN PIERCE COUNTY, WASHINGTON, WITH THE EAST 1/16TH LINE OF SAID SECTION; THENCE SOUTH ALONG THE 1/16TH LINE OF SECTION 35, TOWNSHIP 20 NORTH, RANGE 4 EAST, W.M., A DISTANCE OF 95.4 FEET; THENCE EAST 258.26 FEET; THENCE NORTH TO THE SOUTHERLY LINE OF THE COUNTY ROAD; THENCE NORTHWESTERLY ALONG SAID SOUTHERLY LINE OF COUNTY ROAD TO THE EAST 1/16TH LINE OF SECTION 26; THENCE SOUTH ALONG SAID 1/16TH LINE TO THE POINT OF BEGINNING;

EXCEPT THE WEST 30 FEET THEREOF CONVEYED TO PIERCE COUNTY BY DEED RECORDED UNDER RECORDING NO. 1618885 FOR SHAW COUNTY ROAD.

ALSO EXCEPT THEREFROM THAT PORTION CONVEYED TO THE CITY PUYALLUP BY INSTRUMENT RECORDED UNDER AUDITOR'S FILE NO. 9408230215, BEING A RE-RECORD OF INSTRUMENT RECORDED UNDER AUDITOR'S FILE NO. 9308310480;

AND ALSO EXCEPT ANY PORTION THEREOF LYING SOUTHERLY AND WESTERLY OF A LINE DESCRIBED AS BEGINNING AT THE NORTHWEST CORNER OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SAID SECTION 35, HEREINAFTER CALLED "POINT A"; THENCE SOUTH ALONG THE 1/16TH LINE 95.4 FEET TO THE TRUE POINT OF BEGINNING OF THE LINE TO BE DESCRIBED; THENCE EAST 258.35 FEET; THENCE SOUTH TO A POINT 495.4 FEET SOUTH OF AND 258.35 FEET EAST OF "POINT A"; THENCE EAST TO THE EAST LINE OF SAID PREMISES AND THE TERMINUS OF SAID LINE, SAID POINT ALSO BEING DESCRIBED AS THE SOUTHWEST CORNER OF LOT 3 OF BOUNDARY LINE ADJUSTMENT RECORDED UNDER AUDITOR'S FILE NO. 200303315001;

SITUATE IN THE CITY PUYALLUP, COUNTY OF PIERCE STATE OF WASHINGTON.

TAX PARCEL NO. 0420264053; PER CW TITLE TITLE RESOURCES GUARANTY COMPANY SUBDIVISION GUARANTEE ORDER NO. 40249905-735 DATED JANUARY 22, 2021 AT 8:00 A.M.

THAT PORTION OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SECTION 35, AND THE SOUTHWEST QUARTER OF THE SOUTHEAST QUARTER OF SECTION 26, TOWNSHIP 20 NORTH, RANGE 4 EAST, W.M., IN PIERCE COUNTY, WASHINGTON, DESCRIBED AS FOLLOWS:

COMMENCING AT THE NORTHEAST CORNER OF THE WEST HALF OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SAID SECTION 35 WHICH POINT BEARS NORTH 88°32'51" WEST, 640.11 FEET FROM A BRASS IN CONCRETE MONUMENT MARKING THE NORTHEAST CORNER OF SAID SECTION 35; THENCE ALONG THE EAST LINE OF SAID WEST HALF, SOUTH 01°15'04" WEST, 437.43 FEET TO POINT LYING SOUTH 88°53'30" EAST, 405.26 FEET OF THE EASTERLY EXTENSION OF THE NORTH LINE OF LOT 2 OF THE PIERCE COUNTY SHORT PLAT NO. 9303010321 AND THE TRUE POINT OF BEGINNING; THENCE ALONG SAID NORTHERLY EXTENSION OF THE EAST LINE OF SAID LOT 2, NORTH 01°06'30" EAST, 142.38 FEET TO THE TRUE POINT OF BEGINNING;

EXCEPT THE SOUTH 145.00 FEET THEREOF; (ALSO KNOWN AS LOT 3 OF RECORD OF SURVEY FOR BOUNDARY LINE ADJUSTMENT RECORDED MARCH 31, 2003 UNDER RECORDING NO. 200303315001).

SITUATE IN THE CITY OF PUYALLUP, COUNTY OF PIERCE, STATE OF WASHINGTON.

TAX PARCEL NO. 0420264054; PER CW TITLE TITLE RESOURCES GUARANTY COMPANY SUBDIVISION GUARANTEE ORDER NO. 40249905-735 DATED JANUARY 22, 2021 AT 8:00 A.M.

THAT PORTION OF THE NORTHEAST QUARTER OF SECTION 35, TOWNSHIP 20 NORTH, RANGE 4 EAST, W.M., IN PIERCE COUNTY, WASHINGTON, DESCRIBED AS FOLLOWS:

BEGINNING AT THE NORTHEAST CORNER OF THE WEST HALF OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SECTION 35 WHICH POINT BEARS NORTH 88°32'51" WEST, 640.11 FEET FROM A BRASS IN CONCRETE MONUMENT MARKING THE NORTHEAST CORNER OF SAID SECTION 35; THENCE ALONG THE EAST LINE OF SAID WEST HALF, SOUTH 01°15'04" WEST, 54.00 FEET; THENCE ALONG A LINE PARALLEL WITH THE NORTH LINE OF SAID SECTION 35, NORTH 88°32'51" WEST, 142.38 FEET; THENCE NORTH 01°06'30" EAST, 282.06 FEET TO THE SOUTHERLY MARGIN OF PIONEER WAY; THENCE SOUTH ALONG SAID SOUTHERLY MARGIN, SOUTH 74°08'09" EAST, 179.36 FEET TO A LINE LYING 30.48 FEET EAST OF AND PARALLEL WITH THE EAST LINE OF THE WEST HALF OF THE NORTH EAST QUARTER OF THE NORTHEAST QUARTER OF SAID SECTION 35; THENCE ALONG SAID PARALLEL LINE, SOUTH 01°15'04" WEST, 183.43 FEET TO THE NORTH LINE OF SAID SECTION 35; THENCE ALONG SAID NORTH LINE, NORTH 88°32'51" WEST, 30.48 FEET TO THE POINT OF BEGINNING;

(ALSO KNOWN AS LOT 5 OF RECORD OF SURVEY FOR BOUNDARY LINE ADJUSTMENT RECORDED MARCH 31, 2003 UNDER RECORDING NO. 200303315001).

SITUATE IN THE CITY OF PUYALLUP, COUNTY OF PIERCE, STATE OF WASHINGTON.

TAX PARCEL NO. 0420351066; PER CW TITLE TITLE RESOURCES GUARANTY COMPANY SUBDIVISION GUARANTEE ORDER NO. 40249905-735 DATED JANUARY 22, 2021 AT 8:00 A.M.

COMMENCING AT THE NORTHEAST CORNER OF THE WEST HALF OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SAID SECTION 35 WHICH POINT BEARS NORTH 88°32'51" WEST, 640.11 FEET FROM A BRASS IN CONCRETE MONUMENT MARKING THE NORTHEAST CORNER OF SAID SECTION 35; THENCE ALONG THE EAST LINE OF SAID WEST HALF, SOUTH 01°15'04" WEST, 491.43 FEET TO A POINT LYING SOUTH 88°53'30" EAST, 405.26 FEET TO THE EASTERLY EXTENSION OF THE NORTH LINE OF LOT 2 OF THE PIERCE COUNTY SHORT PLAT NO. 9303010321 AND THE TRUE POINT OF BEGINNING; THENCE ALONG SAID NORTHERLY EXTENSION OF THE EAST LINE OF SAID LOT 2, NORTH 01°06'30" EAST, 145.00 FEET; THENCE SOUTH 88°53'30" EAST, 405.62 FEET TO THE EAST LINE OF THE WEST HALF OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SAID SECTION 35; THENCE ALONG SAID EAST LINE SOUTH 01°15'04" WEST, 145.00 FEET TO THE TRUE POINT OF BEGINNING;

(ALSO KNOWN AS LOT 3 OF RECORD OF SURVEY FOR BOUNDARY LINE ADJUSTMENT RECORDED MARCH 31, 2003 UNDER RECORDING NO. 200303315001).

SITUATE IN THE CITY OF PUYALLUP, COUNTY OF PIERCE, STATE OF WASHINGTON.

TAX PARCEL NO. 0420351030; PER CW TITLE TITLE RESOURCES GUARANTY COMPANY SUBDIVISION GUARANTEE ORDER NO. 40249905-735 DATED JANUARY 22, 2021 AT 8:00 A.M.

BEGINNING AT THE SIXTEENTH SECTION CORNER OF SECTION 35, TOWNSHIP 20 NORTH, RANGE 4 EAST OF THE WILLAMETTE MERIDIAN, 1321.48 FEET WEST OF THE CORNER COMMON TO SECTIONS 25, 26, 35 AND 36;

THENCE SOUTH ALONG THE SIXTEENTH SECTION 95.4 FEET TO THE TRUE POINT OF BEGINNING; THENCE EAST 258.26 FEET; THENCE SOUTH 100 FEET; THENCE WEST 258.26 FEET; THENCE NORTH 100 FEET TO THE TRUE POINT OF BEGINNING, IN PIERCE COUNTY, WASHINGTON.

EXCEPT SHAW COUNTY ROAD.

SITUATE IN THE CITY OF PUYALLUP, COUNTY OF PIERCE, STATE OF WASHINGTON.

TAX PARCEL NO. 0420351029; PER CW TITLE TITLE RESOURCES GUARANTY COMPANY SUBDIVISION GUARANTEE ORDER NO. 40249905-1-E DATED JANUARY 22, 2021 AT 8:00 A.M.

BEGINNING AT THE 1/16 SECTION CORNER, 1321.48 FEET WEST OF CORNER MONUMENT COMMON TO SECTIONS 25, 26, 35 AND 36 IN TOWNSHIP 20 NORTH, RANGE 4 EAST, WILLAMETTE MERIDIAN, IN PIERCE COUNTY, WASHINGTON; THENCE SOUTH ALONG THE 1/16 SECTION LINE 195.4 FEET TO THE TRUE POINT OF BEGINNING; THENCE EAST 258.26 FEET; THENCE SOUTH 100 FEET; THENCE WEST 258.26 FEET; THENCE NORTH 100 FEET TO TRUE POINT OF BEGINNING.

EXCEPT THE WEST 30 FEET THEREOF FOR ROAD.

SITUATE IN THE COUNTY OF PIERCE, STATE OF WASHINGTON.

TAX PARCEL NO. 0420351026; PER CW TITLE TITLE RESOURCES GUARANTY COMPANY SUBDIVISION GUARANTEE ORDER NO. 40249906-735 DATED JANUARY 22, 2021 AT 8:00 A.M.

BEGINNING AT THE 1/16 SECTION CORNER 1321.48 FEET WEST OF THE CORNER MONUMENT COMMON TO SECTIONS 25, 26, 35 AND 36 IN TOWNSHIP 20 NORTH, RANGE 4 EAST, WILLAMETTE MERIDIAN, IN PIERCE COUNTY, WASHINGTON; THENCE SOUTH ALONG THE 1/16 SECTION LINE 294.5 FEET TO THE TRUE POINT OF BEGINNING; THENCE EAST 258.35 FEET; THENCE SOUTH 100 FEET; THENCE WEST 258.35 FEET; THENCE NORTH 100 FEET TO THE TRUE POINT OF BEGINNING, IN PIERCE COUNTY, WASHINGTON.


EXCEPT SHAW COUNTY ROAD.

SITUATE IN THE CITY OF PUYALLUP, COUNTY OF PIERCE, STATE OF WASHINGTON.



**VICINITY MAP**

1" = 1000'  
2902 E PIONEER WAY

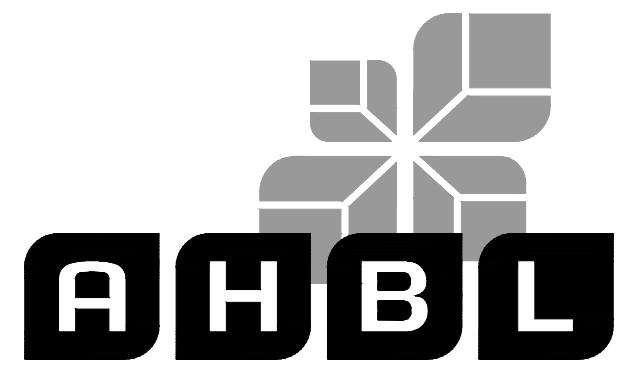

2215 North 30th Street, Suite 300, Tacoma, WA 98403  
253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

**EAST TOWN CROSSING PHASE 1**

Client: ASH DEVELOPMENT

GREG HELLE  
GREG.HELLE@ASHNW.COM

Project No. 2230752

Issue Set & Date: PERMIT SUBMITTAL

04/09/2024



NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE AN ENDORSEMENT OR A GUARANTEE BY THE ENGINEER FOR THE PROJECT EXHIBIT IN THE TITLE BLOCK AND IS NOT TO BE USED FOR ANY OTHER PROJECT, IN ADDITION TO THAT PROJECT FOR WHICH THE ENGINEER HAS BEEN RETAINED.

City of Puyallup Development & Permitting Services ISSUED PERMIT. Includes color-coded boxes for Building, Planning, Engineering, Public Works, Fire, and Traffic.

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title: COVER SHEET

Designed by: CW, Drawn by: SK / RS, Checked by: JI

Sheet No. C0.0



Know what's below. Call before you dig.



# EAST TOWN CROSSING PHASE 1



## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

**APPROVED**

BY:   
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING





DATE: 06/06/2024

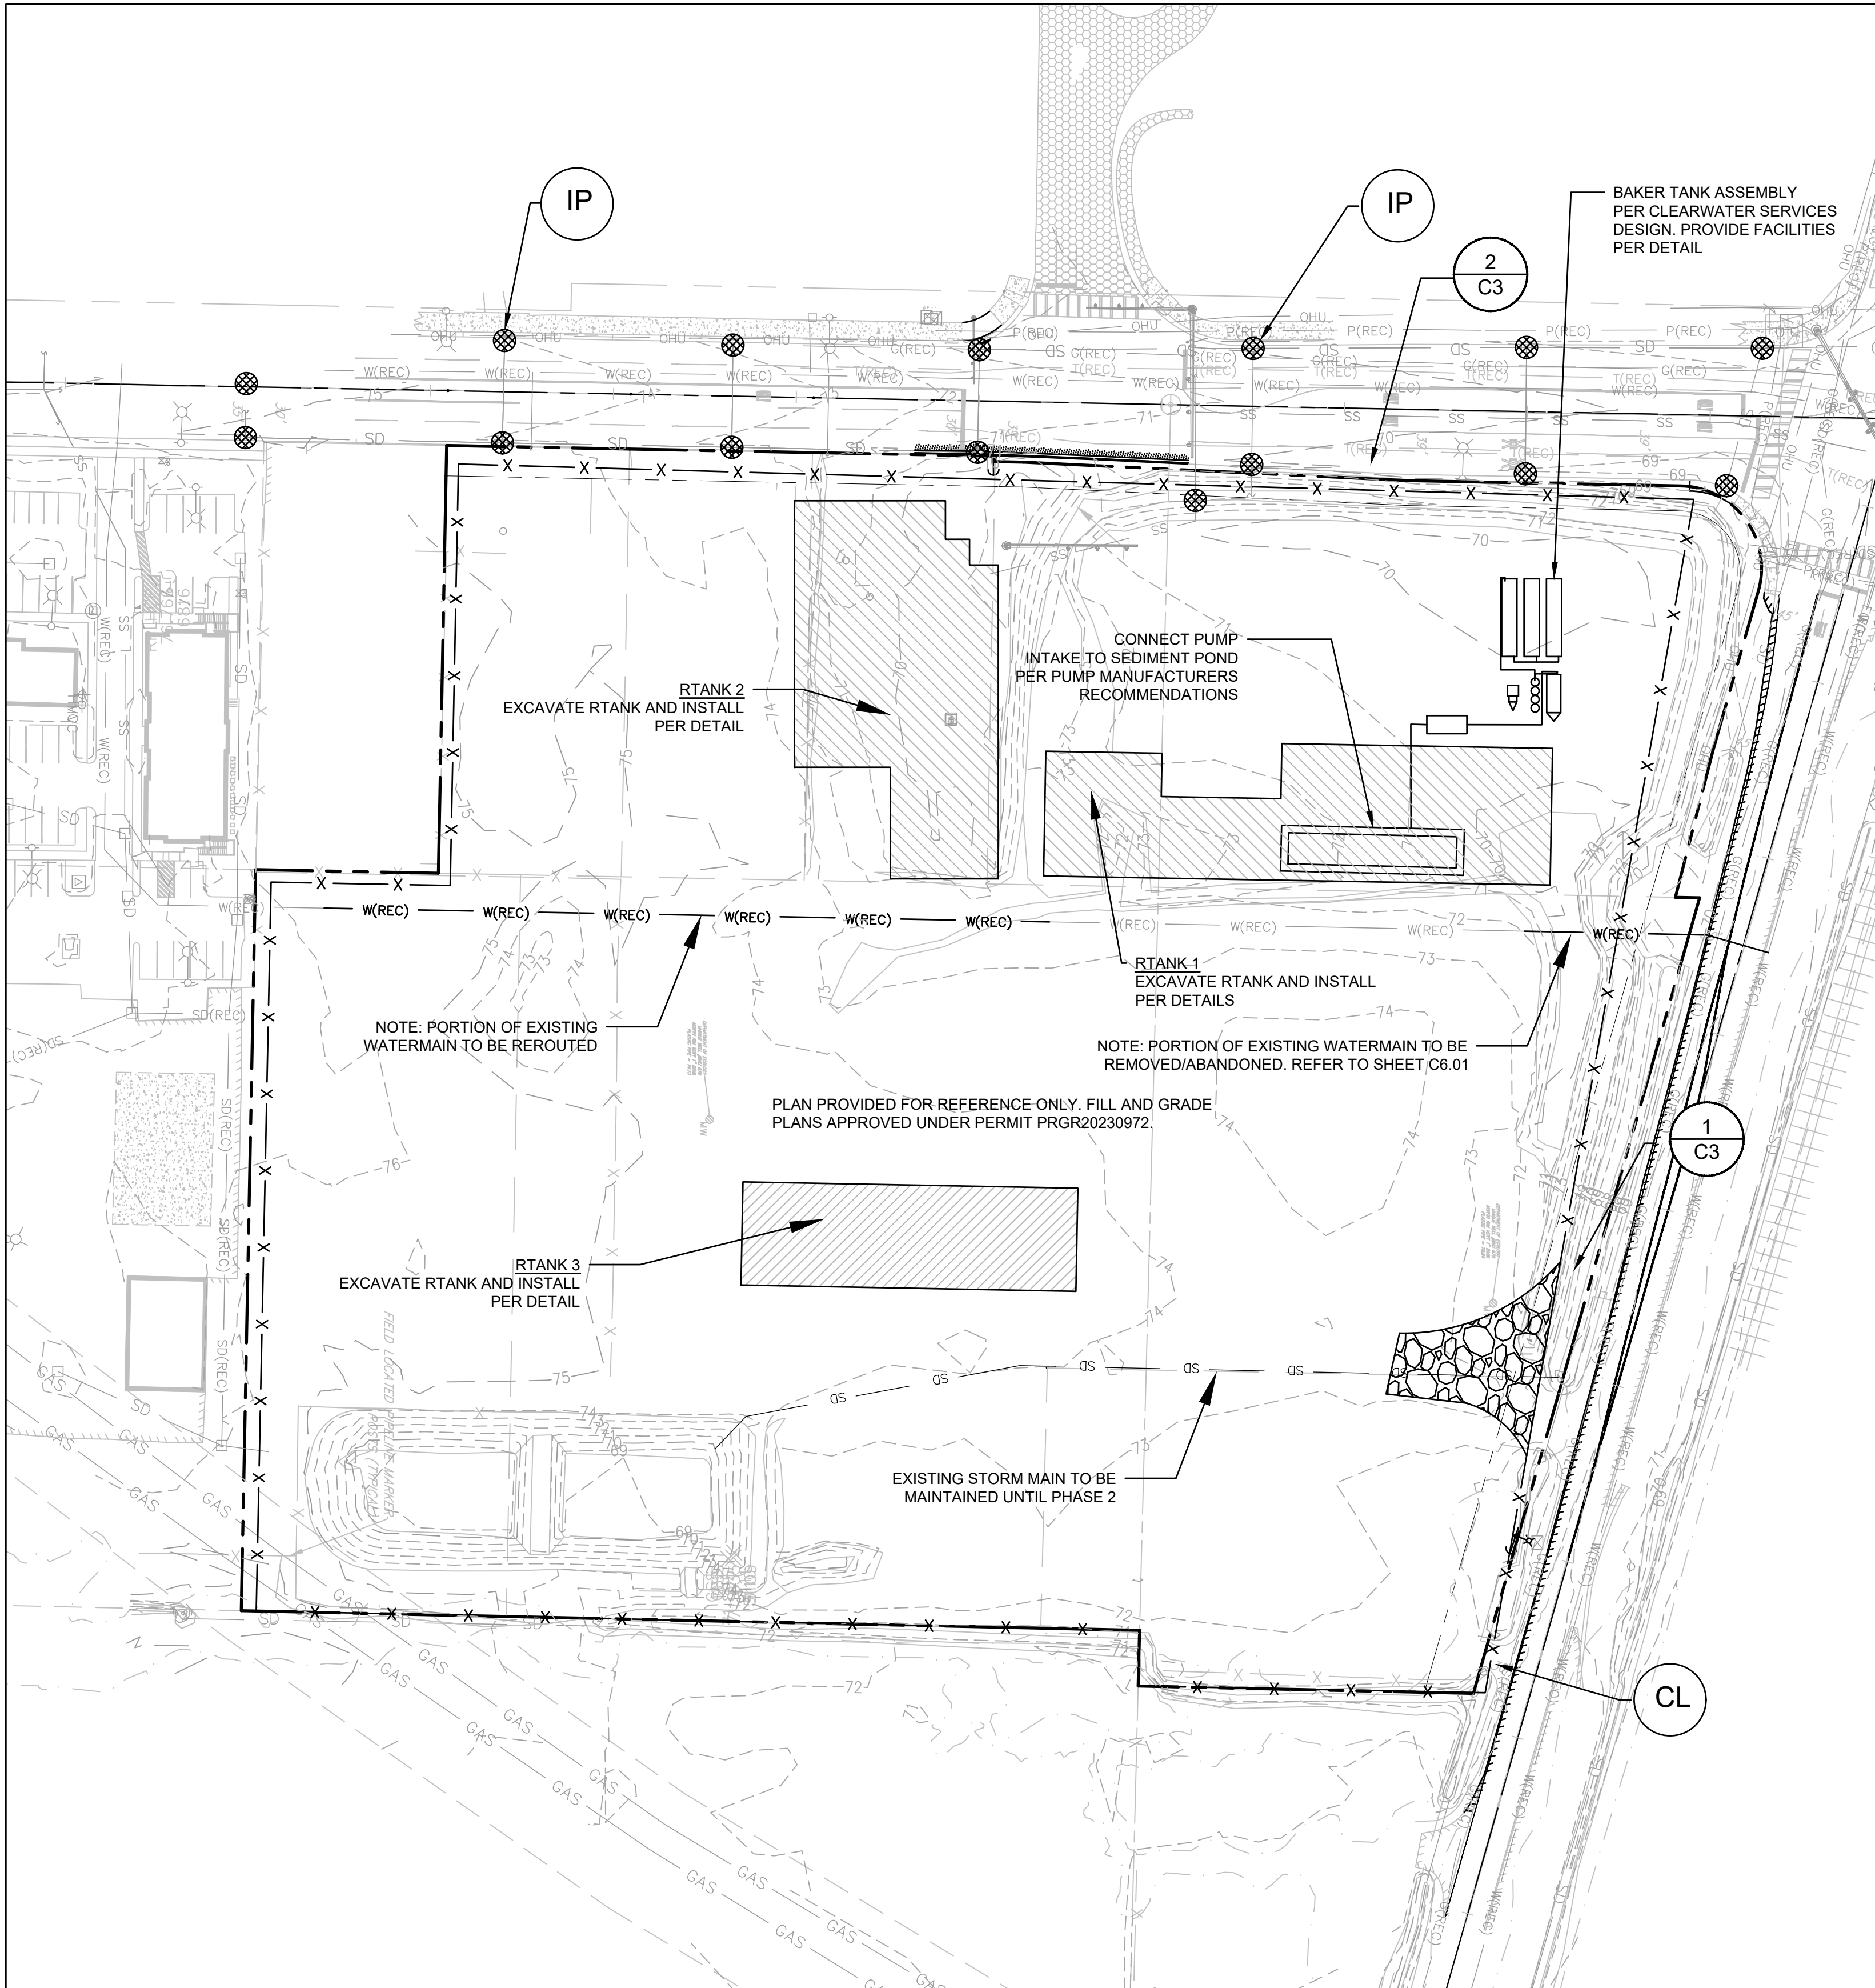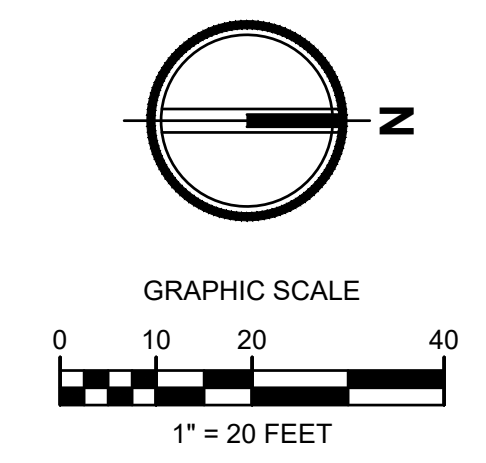NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.



**NOTE:**  
 MAINTAIN SEDIMENT POND AND BAKER TANKS AS DESIGNED IN CLEAR. FILL AND GRADE PLANS PER CFG APPLICATION NUMBER PRGR20230972

**TESC LEGEND:**

	CL	CLEARING/ GRADING/ DISTURBED LIMITS
	FF	FILTER FABRIC FENCE SEE DETAIL
	CE	CONSTRUCTION ENTRANCE
	IP	INLET PROTECTION

**Project Title:**  
**EAST TOWN CROSSING PHASE 1**

**Client:**  
 ASH DEVELOPMENT  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM

**Project No.:**  
 2230752

**Issue Set & Date:**  
 PERMIT SUBMITTAL





05/17/2024



NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PUBLICATION OF THE DOCUMENT DOES NOT CONSTITUTE A PROFESSIONAL ENGINEER'S RESPONSIBILITY TO THE GENERAL PUBLIC OR THE ONLY FOR THE PROJECT DESCRIBED IN THE TITLE BLOCK AND IS NOT TO BE USED FOR OTHER PROJECTS OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

**City of Puyallup  
 Development & Permitting Services  
 ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

-  \_\_\_\_\_
-  \_\_\_\_\_
-  03/29/24 CITY COMMENTS
-  01/29/24 CITY COMMENTS

**Revisions:**

\_\_\_\_\_

\_\_\_\_\_

**Sheet Title:**  
**TESC PLAN**

**Designed by:** CW    **Drawn by:** SK / RS    **Checked by:** JI

**Sheet No.:**  
**C1.0**  
 2 of 53 Sheets





**TESC INSPECTION NOTES:**


- INSPECT ALL INLET PROTECTION ON CATCH BASINS. CLEAN OR REPLACE IF FULL OF SEDIMENT /DEBRIS AND REPAIR/REPLACE AS NEEDED IF DAMAGED TO MAINTAIN PROTECTION.
- INSPECT ALL PERMANENT AND TEMPORARY STABILIZED SLOPES. REPAIR ANY DAMAGED SECTIONS AND RE-VEGETATE AS NEEDED TO ENSURE THE ESTABLISHMENT OF VEGETATION AND THAT NO EROSION OF THE SLOPES OCCUR.
- INSPECT ALL FILTER FABRIC FENCING FOR SIGNS OF EROSION, DAMAGE OR FAILURES. REPAIR AND/OR REPLACE AS NEEDED. SEE FILTER FABRIC NOTES. SEDIMENT BUILD-UP ALONG FENCE SHALL BE REMOVED WHEN REACHES 1/3 THE FENCE HEIGHT. IF EROSION IS OCCURRING, CONTRACTOR SHALL INSTALL ADDITIONAL EROSION CONTROL MEASURES AS NEEDED TO PREVENT EROSION.
- ANY FILL/CUT SLOPES SHALL BE INSPECTED FOR EROSION. IF SIGNS OF EROSION ARE PRESENT, INSTALL APPROPRIATE BMPs AS NEEDED TO STOP EROSION AND STABILIZE SLOPES.
- TESC LEAD RESPONSIBLE FOR NOTIFYING ENGINEER IF ADDITIONAL MEASURES ARE WARRANTED.

**PERMANENT STABILIZATION NOTES:**

- ALL EXPOSED SOILS AND SLOPES SHALL BE SEEDED OR OTHERWISE STABILIZED IMMEDIATELY AFTER CONSTRUCTION AND GRADING ACTIVITIES HAVE BEEN COMPLETED.
- SILT FENCE, IF DEEMED APPROPRIATE, SHALL REMAIN FOR A MINIMUM OF 30 DAYS AFTER THE FINAL STABILIZATION OF THE SLOPES HAS OCCURRED.
- ALL TEMPORARY EROSION CONTROL BMPs SHALL BE REMOVED 30 DAYS AFTER FINAL STABILIZATION HAS OCCURRED AS DIRECTED BY CITY OR COUNTY INSPECTOR.
- CONTRACTOR SHALL REFER TO THE CONSTRUCTION SWPPP FOR APPLICABLE BMPs.

**CONSTRUCTION ENTRANCE NOTES:**


- MATERIAL SHALL BE 4" TO 8" QUARRY SPALLS (4 TO 6 INCH FOR RESIDENTIAL SINGLE FAMILY LOTS) AND MAY BE TOP-DRESSED WITH 1 TO 3 INCH ROCK.
- THE ROCK PAD SHALL BE AT LEAST 12" THICK AND 100' LONG (REDUCED TO 20 FEET FOR SITES LESS THAN 1 ACRE OF DISTURBED SOIL) WIDTH SHALL BE FULL WIDTH OF INGRESS AND EGRESS AREA. SMALLER PADS MAY BE APPROVED FOR SINGLE-FAMILY RESIDENTIAL AND COMMERCIAL SITES.
- ADDITIONAL ROCK SHALL BE ADDED PERIODICALLY TO MAINTAIN FUNCTION OF THE PAD.
- IF THE PAD DOES NOT ADEQUATELY REMOVE MUD FROM THE VEHICLE WHEELS, THE WHEELS SHALL BE HOSED OFF BEFORE THE VEHICLE ENTERS A PAVED STREET. THE WASHING SHALL BE DONE ON AN AREA COVERED WITH CRUSHED ROCK AND WASH WATER SHALL DRAIN TO A SEDIMENT RETENTION FACILITY OR THROUGH A SILT FENCE.
- CONSTRUCTION ACCESS IS FORBIDDEN ALONG SHAW ROAD FOR THE DURATION OF CONSTRUCTION.

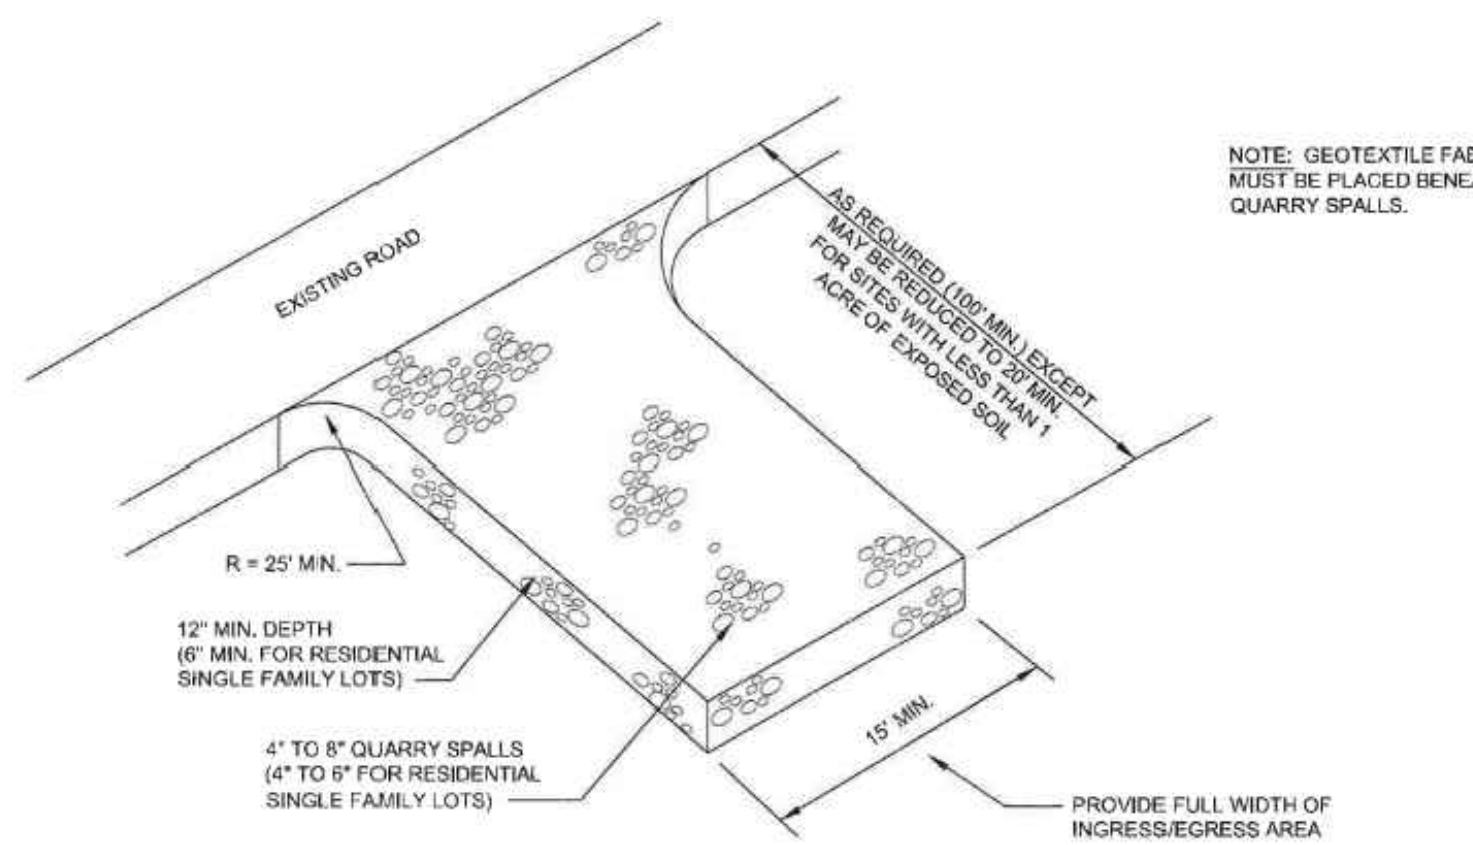

**1 CONSTRUCTION ENTRANCE SCALE:NTS**

**FILTER FABRIC FENCE NOTES:**

- SUPPORT POST, WITH A MINIMUM 6-INCH OVERLAP, AND SECURELY FASTENED AT BOTH ENDS TO POSTS.
- POSTS SHALL BE SPACED A MAXIMUM OF 6 FEET APART AND DRIVEN SECURELY INTO THE GROUND (MINIMUM OF 30 INCHES).
- A TRENCH SHALL BE EXCAVATED APPROXIMATELY 8 INCHES WIDE AND 12 INCHES DEEP ALONG THE LINE OF POSTS AND UPSLOPE FROM THE BARRIER. THIS TRENCH SHALL BE BACKFILLED WITH WASHED GRAVEL.
- WHEN STANDARD STRENGTH FILTER FABRIC IS USED, A WIRE MESH SUPPORT FENCE SHALL BE FASTENED SECURELY TO THE UPSLOPE SIDE OF THE TRENCH USING HEAVY-DUTY WIRE STAPLES AT LEAST 1 INCH LONG. THE WIRES OR HOG RINGS, THE WIRE SHALL EXTEND INTO THE TRENCH A MINIMUM OF 4 INCHES AND SHALL NOT EXTEND MORE THAN 24 INCHES ABOVE THE ORIGINAL GROUND SURFACE.
- THE STANDARD STRENGTH FILTER FABRIC SHALL BE STAPLED OR WIRED TO THE FENCE, AND 20 INCHES OF THE FABRIC SHALL BE EXTENDED INTO THE TRENCH. THE FABRIC SHALL NOT EXTEND MORE THAN 24 INCHES ABOVE THE ORIGINAL GROUND SURFACE. FILTER FABRIC SHALL NOT BE STAPLED TO EXISTING TREES.
- WHEN EXTRA-STRENGTH FILTER FABRIC AND CLOSER POST SPACING IS USED, THE WIRE MESH SUPPORT FENCE MAY BE ELIMINATED. IN SUCH A CASE, THE FILTER FABRIC IS STAPLED OR WIRED DIRECTLY TO THE POSTS WITH ALL OTHER PROVISIONS OF ABOVE NOTES APPLYING.
- FILTER FABRIC FENCES SHALL NOT BE REMOVED BEFORE THE UPSLOPE AREA HAS BEEN PERMANENTLY STABILIZED.
- FILTER FABRIC FENCES SHALL BE INSPECTED IMMEDIATELY AFTER EACH RAINFALL AND AT LEAST DAILY DURING PROLONGED RAINFALL. ANY REQUIRED REPAIRS SHALL BE MADE IMMEDIATELY.
- SILT FENCES WILL BE INSTALLED PARALLEL TO ANY SLOPE CONTOURS.
- CONTRIBUTING LENGTH TO FENCE WILL NOT BE GREATER THAN 100 FEET.
- DO NOT INSTALL BELOW AN OUTLET PIPE OR WEIR.
- INSTALL DOWNSLOPE OF EXPOSED AREAS.
- DO NOT DRIVE OVER OR FILL OVER SILT FENCES.

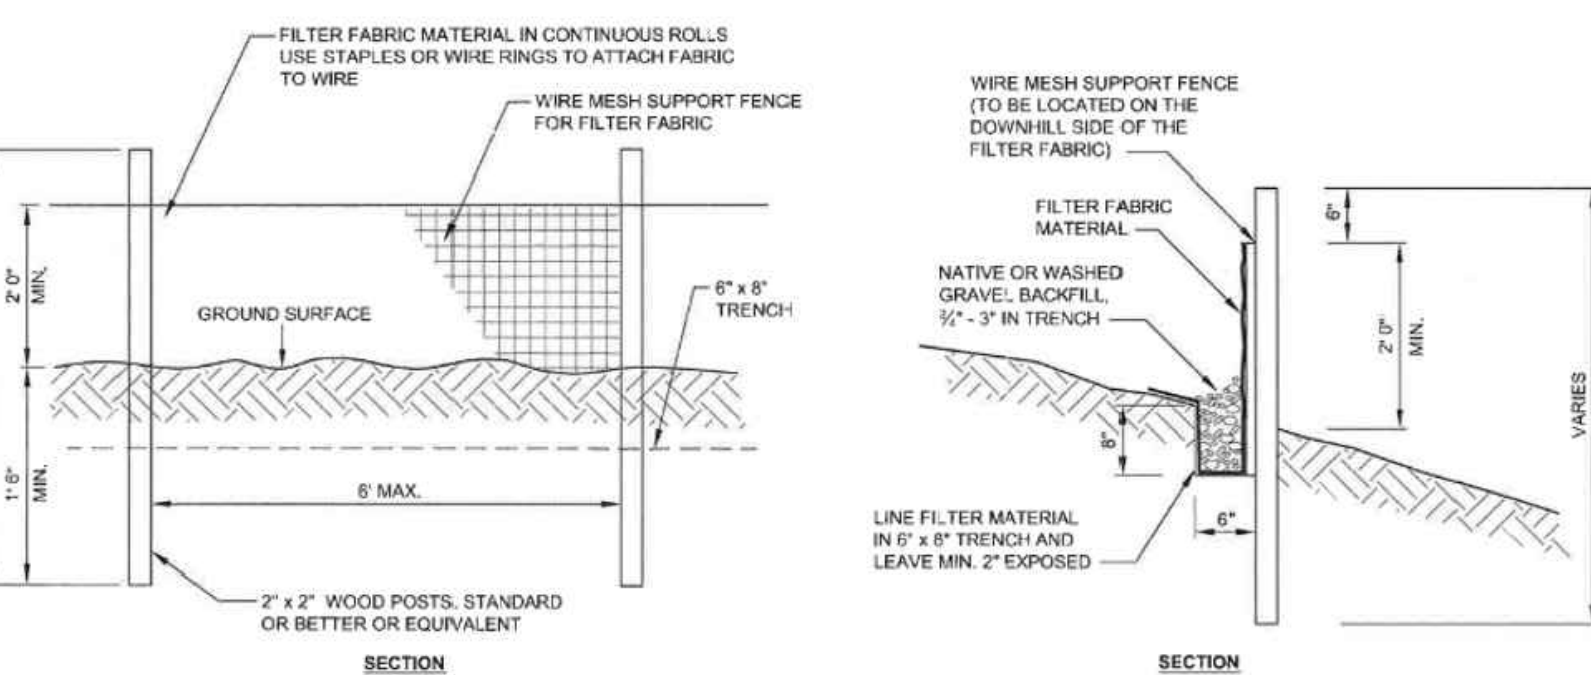

**2 FILTER FABRIC FENCE SCALE:NTS**



Know what's below. Call before you dig.

# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

**AMENDED SOILS NOTES:**

- SOIL AMENDMENTS ARE REQUIRED FOR ALL DISTURBED AREAS IN ACCORDANCE WITH BMP L613: POST-CONSTRUCTION SOIL QUALITY AND DEPTH OF THE 2021 SURFACE WATER MANAGEMENT MANUAL.
- AMENDED SOILS SHALL BE A MINIMUM OF 8" (NON-COMPACTED) WITH SUBSOILS SCARIFIED AT LEAST 4" WITH INCORPORATION OF THE UPPER MATERIAL TO AVOID STRATIFIED LAYERS, WHERE FEASIBLE.
- QUALITY OF COMPOST AND OTHER MATERIALS USED TO MEET THE ORGANIC CONTENT REQUIREMENTS ARE AS FOLLOWS:
  - THE ORGANIC CONTENT FOR "PRE-APPROVED" AMENDMENT RATES CAN BE MET ONLY USING COMPOST THAT MEETS THE DEFINITION OF "COMPOSTED MATERIALS" IN WAC 173-350-220. THE WAC IS AVAILABLE ONLINE AT: [HTTP://WWW.ECY.WA.GOV/PROGRAMS/SWFA/FACILITIES/350.HTML](http://www.ecy.wa.gov/PROGRAMS/SWFA/FACILITIES/350.HTML). THE COMPOST MUST ALSO HAVE AN ORGANIC MATTER CONTENT OF 35% TO 65%, AND A CARBON TO NITROGEN RATIO BELOW 25:1. THE CARBON TO NITROGEN RATIO MAY BE AS HIGH AS 35:1 FOR PLANTING (S) COMPOSED ENTIRELY OF PLANTS NATIVE TO THE PUGET SOUND LOWLANDS REGION.
  - CALCULATED AMENDMENT RATES MAY BE MET THROUGH USE OF COMPOSTED MATERIALS AS DEFINED ABOVE, OR OTHER ORGANIC MATERIALS AMENDED TO MEET THE CARBON TO NITROGEN RATIO REQUIREMENTS, AND MEETING THE CONTAMINANT STANDARDS OF GRADE A COMPOST.
- USE ONE OF THE FOLLOWING OPTIONS TO MEET THE POST CONSTRUCTION SOIL QUALITY AND DEPTH REQUIREMENTS. USE THE MOST RECENT VERSION OF "GUIDELINES FOR RESOURCES FOR IMPLEMENTING SOIL QUALITY AND DEPTH BMP 15.13" TO MEET THE REQUIREMENTS OF THIS BMP. THIS GUIDANCE CAN BE FOUND ONLINE AT [WWW.SOILFORALMON.ORG](http://WWW.SOILFORALMON.ORG)
  - LEAVE NATIVE VEGETATION AND SOIL UNDISTURBED, AND PROTECT FROM COMPACTION DURING CONSTRUCTION.
  - AMEND EXISTING SITE TOPSOIL OR SUBSOIL EITHER AT DEFAULT "PRE-APPROVED" RATES, OR AT CUSTOM CALCULATED RATES BASED ON SPECIFIC TESTS OF THE SOIL AND AMENDMENT.
  - STOCKPILE EXISTING TOPSOIL DURING GRADING, AND REPLACE IT PRIOR TO PLANTING. STOCKPILED TOPSOIL MUST ALSO BE AMENDED IF NEEDED TO MEET THE ORGANIC MATTER OR DEPTH REQUIREMENTS, EITHER AT A DEFAULT "PRE-APPROVED" RATE OR AT A CUSTOM CALCULATED RATE.
  - IMPORT TOPSOIL MIX OF SUFFICIENT ORGANIC CONTENT AND DEPTH TO MEET THE REQUIREMENTS. MORE THAN ONE METHOD MAY BE USED ON DIFFERENT PORTIONS OF THE SAME SITE. SOIL THAT ALREADY MEETS THE DEPTH AND ORGANIC MATTER QUALITY STANDARDS, AND IS NOT COMPACTED, DOES NOT NEED TO BE AMENDED.
- AMENDED SOILS SHALL BE MAINTAINED AS FOLLOWS:
  - SOIL QUALITY AND DEPTH SHOULD BE ESTABLISHED TOWARD THE END OF CONSTRUCTION AND ONCE ESTABLISHED, SHOULD BE PROTECTED FROM COMPACTION, SUCH AS FROM LARGE MACHINERY USE, AND FROM EROSION.
  - SOIL SHOULD BE PLANTED AND MULCHED AFTER INSTALLATION.
  - SOIL DEBRIS OR ITS EQUIVALENT SHOULD BE LEFT ON THE SOIL SURFACE TO REPLENISH ORGANIC MATTER.
  - IT SHOULD BE POSSIBLE TO REDUCE USE OF IRRIGATION, FERTILIZERS, HERBICIDES AND PESTICIDES. THESE ACTIVITIES SHOULD BE ADJUSTED WHERE POSSIBLE, RATHER THAN CONTINUING TO IMPLEMENT FORMERLY ESTABLISHED PRACTICES.
- SEE PROJECT CONSTRUCTION SWPPP FOR ADDITIONAL INFORMATION OR SECTION 2.2.1.4 OF CHAPTER 2 OF VOLUME 6 OF THE 2021 SURFACE WATER MANAGEMENT MANUAL.

**MULCHING NOTES:**

- MULCH MATERIALS USED SHALL BE STRAW OR HAY, AND SHALL BE APPLIED AT THE RATE OF 75-100 POUNDS PER 1000 SQ. FT. (APPX 2" THICK).
- MULCH SHALL BE APPLIED IN ALL AREAS WITH EXPOSED SLOPES GREATER THAN 2:1.
- MULCHING SHALL BE USED IMMEDIATELY AFTER SEEDING OR IN AREAS WHICH CANNOT BE SEEDED BECAUSE OF THE SEASON.
- ALL AREAS NEEDING MULCH SHALL BE COVERED BY NOVEMBER 1.

**CONTRACTOR NOTES:**

- INLET PROTECTION SHALL BE INSTALLED IN ALL NEWLY CONSTRUCTED CATCH BASINS AND ALONG ALL IMPACTED FRONTAGE AND OFFSITE AREAS PER THE REQUIREMENTS OF THE COUNTY INSPECTOR PER DETAIL 5 ON THIS SHEET 5.
- CONSTRUCTION FENCE CAN BE UTILIZED IN PLACE OF FILTER FABRIC FENCE ONLY IN AREAS WHERE THE GRADES DO NOT ALLOW THE POTENTIAL FOR ANY STORMWATER TO LEAVE THE SITE.
- ALL DEMOLISHED MATERIALS SHALL BE REMOVED FROM THE SITE AND DISPOSED OF AT A CITY APPROVED LOCATION AND IN A MANNER CONSISTENT WITH CURRENT REGULATIONS AND REQUIREMENTS.
- ALL AREAS THAT WILL BE UNWORKED FOR MORE THAN SEVEN (7) DAYS DURING THE DRY SEASON OR TWO (2) DAYS DURING THE WET SEASON, SHALL BE COVERED WITH STRAW, WOOD FIBER MULCH, COMPOST, PLASTIC SHEETING, OR OTHER EQUIVALENT PER CURRENT CITY OR COUNTY STANDARDS. SEE SEEDING NOTES AND MULCHING NOTES ON THIS SHEET.
- CONTRACTOR SHALL DESIGNATE A WASHINGTON DEPT OF ECOLOGY CERTIFIED EROSION CONTROL LEAD PERSON, AND SHALL COMPLY WITH THE CONSTRUCTION STORMWATER POLLUTION PREVENTION PLAN (SWPPP) PREPARED FOR THE PROJECT.
- AT ANY TIME DURING CONSTRUCTION IT IS DETERMINED BY THE CITY OR COUNTY THAT MUD AND DEBRIS ARE BEING TRACKED ONTO PUBLIC STREETS WITH INSUFFICIENT CLEANUP, ALL WORK SHALL CEASE ON THE PROJECT UNTIL THIS CONDITION IS CORRECTED. THE CONTRACTOR AND/OR THE OWNER SHALL IMMEDIATELY TAKE ALL STEPS NECESSARY TO PREVENT FUTURE TRACKING OF MUD AND DEBRIS INTO THE PUBLIC ROW, WHICH MAY INCLUDE THE INSTALLATION OF A WHEEL WASH FACILITY ON-SITE.
- SEDIMENT LADEN RUNOFF SHALL NOT BE ALLOWED TO DISCHARGE BEYOND THE LIMITS OF THE IMPROVEMENTS. ADDITIONAL MEASURES SHALL BE INSTALLED AS NEEDED.
- SAND BAGS SHALL BE SECURELY PLACED AROUND INSTALLED CATCH BASINS WITH INLET PROTECTION AS FIELD AND WEATHER CONDITIONS WARRANT SO TO PROTECT ALL DISPERSION AND INFILTRATION TRENCHES SEDIMENT LADEN RUNOFF.
- TREES WITHIN WORKING LIMITS TO BE SAVED, SHALL BE MARKED AS SUCH ON SITE AND PROTECTION FENCE PLACED AROUND EACH TREE.

**SEEDING NOTES:**

- THE FOLLOWING SEED MIXTURE SHALL BE AS BELOW AND SHALL BE APPLIED AT THE RATE RECOMMENDED BY THE SUPPLIER.

TABLE D.3.2.B TEMPORARY EROSION CONTROL SEED MIX			
	% WEIGHT	% PURITY	% GERMINATION
CHEWINGS OR RED FESCUE FESTUCA FESTUCA VAR. COMMUTATA OR FESTUCA RUBRA	40	98	90
ANNUAL OR PERENNIAL RYE LOLIUM MULTIFLORUM OR LOLIUM PERENNE	40	98	90
REDDTOP OR COLONIAL BENTGRASS AGROSTIS ALBA OR AGROSTIS TENUIS	10	92	85
WHITE DUTCH CLOVER TRIFOLIUM REPENS	10	98	90

- SEED BEDS PLANTED BETWEEN MAY 1 AND OCTOBER 31 WILL REQUIRE IRRIGATION AND OTHER MAINTENANCE AS NECESSARY TO FOSTER AND PROTECT THE ROOT STRUCTURE.
- FOR SEED BEDS PLANTED BETWEEN OCTOBER 31 AND APRIL 30, ARMORING OF THE SEED BED WILL BE NECESSARY. (E.G., GEOTEXTILES, JUTE MAT, CLEAR PLASTIC COVERING).
- BEFORE SEEDING, INSTALL NEEDED SURFACE RUNOFF CONTROL MEASURES SUCH AS GRADIENT TERRACES, INTERCEPTOR DIKES, SWALES, LEVEL SPREADERS AND SEDIMENT BASINS.
- THE SEEDBED SHALL BE FIRM WITH A FAIRLY FINE SURFACE, FOLLOWING SURFACE ROUGHENING. PERFORM ALL OPERATIONS ACROSS OR AT RIGHT ANGLES TO THE SLOPE.
- FERTILIZERS ARE TO BE USED ACCORDING TO SUPPLIER'S RECOMMENDATIONS. AMOUNTS USED SHOULD BE MINIMIZED, ESPECIALLY ADJACENT TO WATER BODIES AND WETLANDS.

APPROVED

BY:   
CITY OF PUYALLUP  
DEVELOPMENT ENGINEERING

DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.



TACOMA · SEATTLE · SPOKANE · TRI-CITIES

2215 North 30th Street, Suite 300, Tacoma, WA 98403  
253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:

### EAST TOWN CROSSING PHASE 1

Client:  
ASH DEVELOPMENT

GREG HELLE

GREG.HELLE@ASHNW.COM


Project No.

2230752

Issue Set & Date:

### PERMIT SUBMITTAL

05/17/2024

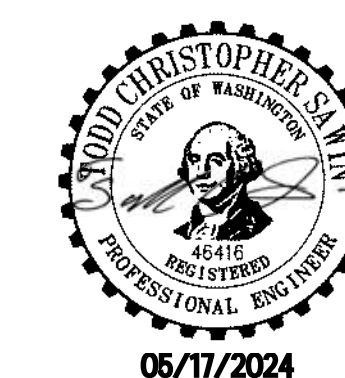

NOTICE  
A SIGNATURE OF THIS DOCUMENT SHALL VALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT GUARANTEE THAT THE INFORMATION IS CORRECT OR THAT THE DESIGNER IS NOT RESPONSIBLE FOR THE PROJECT. THIS BLOCK OF INFORMATION IS NOT TO BE USED FOR ANY OTHER PROJECT.

**City of Puyallup Development & Permitting Services ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

A

A

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title:

### TESC NOTES AND DETAILS


Designed by: CW Drawn by: SK/RS Checked by: JI

Sheet No.

## C1.1

3 of 53 Sheets

**3 INLET PROTECTION WITH FABRIC FENCE SCALE:NTS**

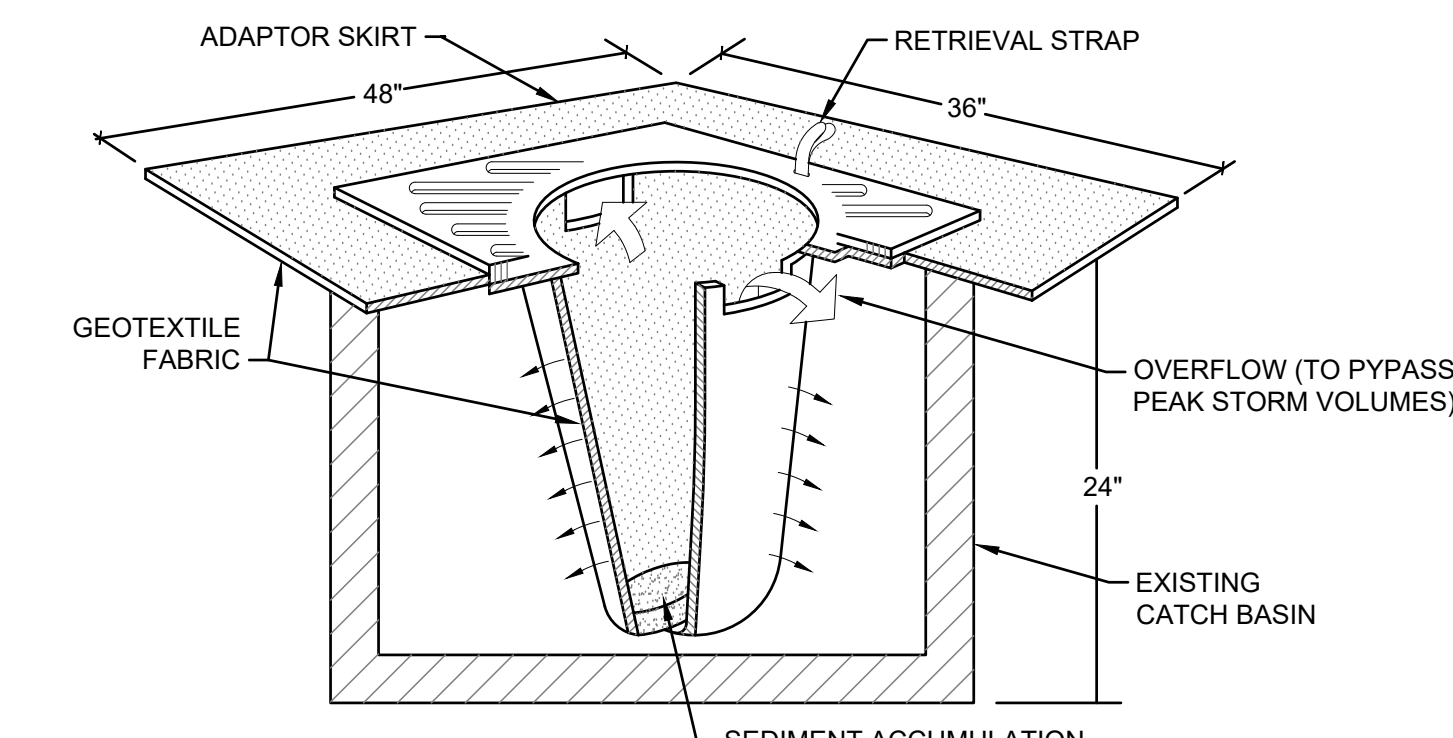

- NOTES:
- FILTERS SHALL BE INSPECTED AFTER EACH STORM EVENT AND CLEANED OR REPLACED WHEN 1/3 FULL.
  - INSTALL INLET PROTECTION IN ALL NEW STORM STRUCTURES THAT WILL COLLECT STORMWATER AS THEY ARE INSTALLED.



**4 INLET PROTECTION W/ FILTER SOCK SCALE:NTS**



# EAST TOWN CROSSING PHASE 1


## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.  
 THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.  
 FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

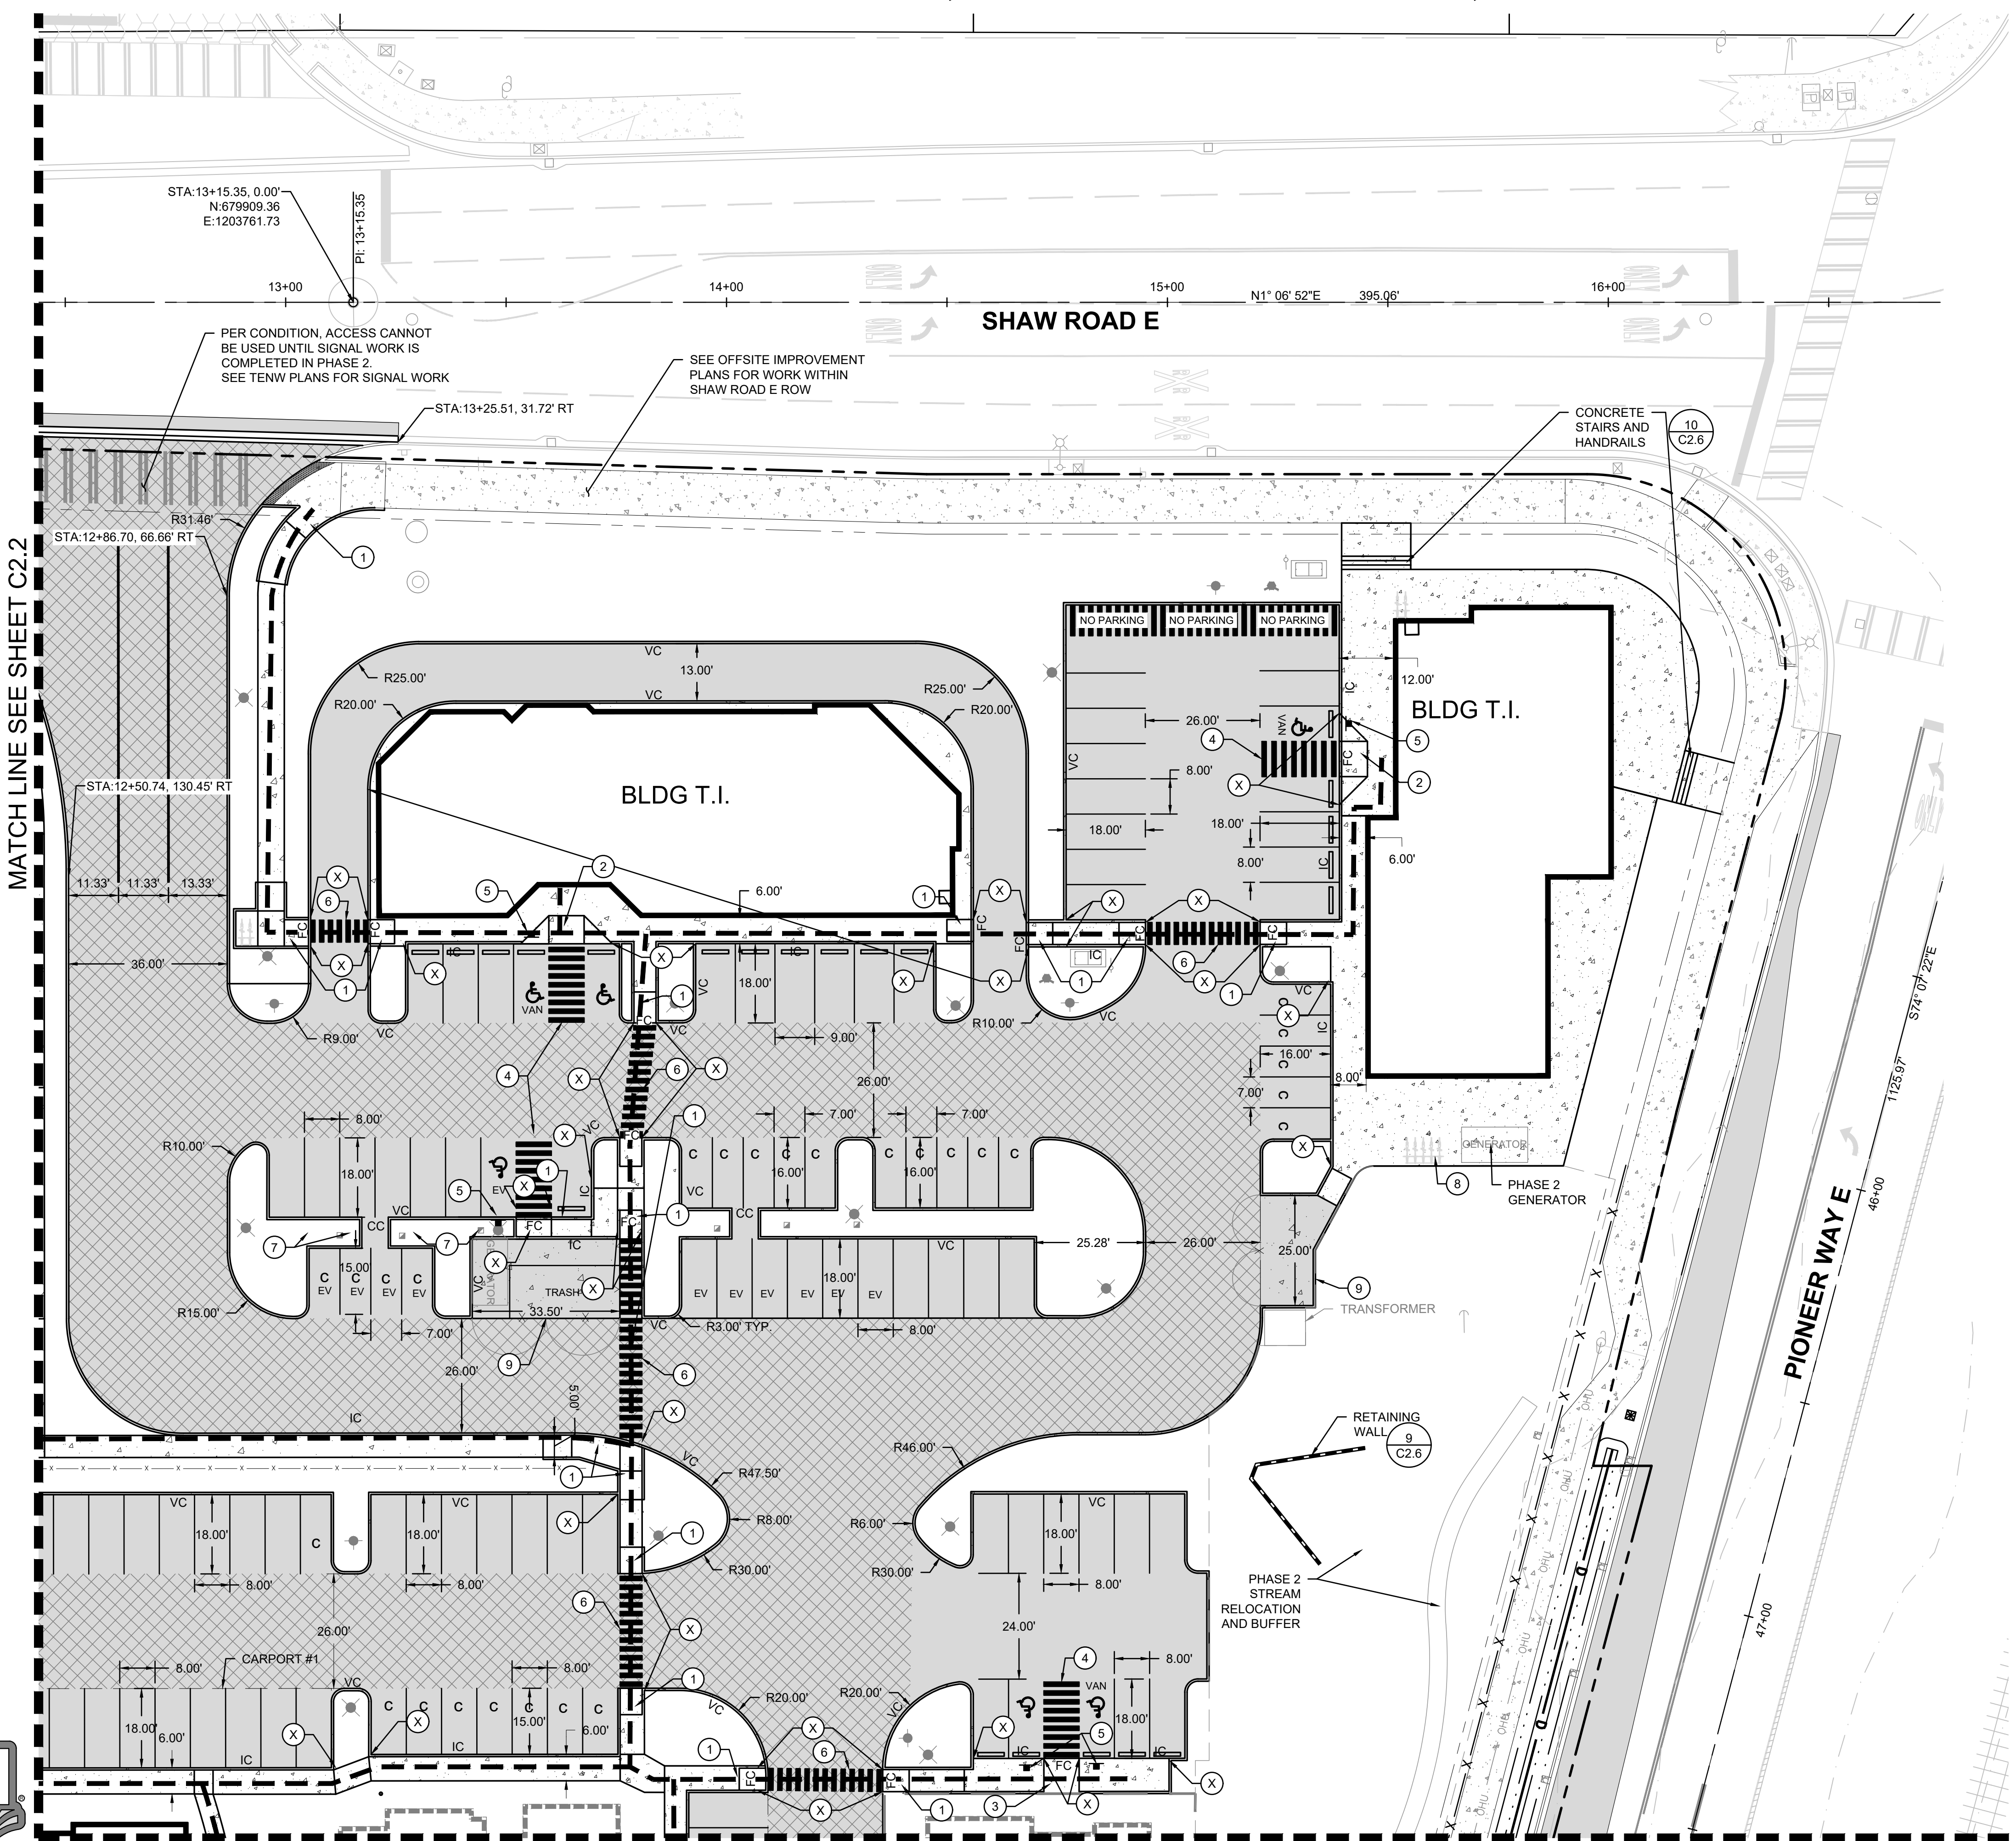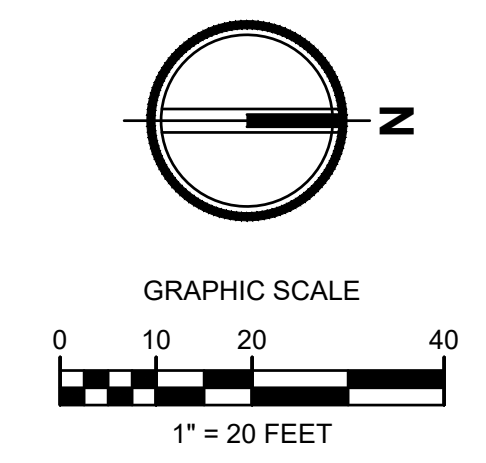

- LEGEND:**
- RIGHT-OF-WAY/PROPERTY LINE
  - CENTERLINE
  - PROPOSED BUILDING OUTLINE
  - - - - - FENCING - REFER TO LANDSCAPE ARCHITECTS DRAWINGS.
  - - - - - ACCESSIBLE PATH
  - ASPHALT PAVEMENT - STANDARD DUTY (1 C2.6)
  - ASPHALT PAVEMENT - ATB (2 C2.6)
  - PERVIOUS CONCRETE SIDEWALK (3 C2.6)
  - CEMENT CONCRETE - HEAVY DUTY (4 C2.6)
  - BOLLARD PROTECTION
  - CEMENT CONCRETE WHEEL STOP (7 C2.6)
  - ☼ LIGHTING - REFER TO ELECTRICAL PLANS
  - ♿ ADA ACCESSIBLE PARKING STALL (5 C2.7)
  - (X) CHANGE IN CURB TYPE / END CURB
  - EC CONCRETE EXTRUDED CURB (5 C2.6)
  - IC INTEGRAL CURB AND SIDEWALK (5 C2.6)
  - NC NO CURB (8 C2.6)
  - CC CURB CUT (6 C2.6)
  - VC VERTICAL CURB (6 C2.6)
  - CG CONCRETE CURB AND GUTTER
  - FC FLUSH CURB

- KEYNOTES**
- 1 ADA RAMP - SINGLE DIRECTIONAL (1 C2.7)
  - 2 ADA RAMP - PERPENDICULAR (3 C2.7)
  - 3 ADA RAMP - DEPRESSED SIDEWALK (2 C2.7)
  - 4 ADA STALL (5 C2.7)
  - 5 ADA SIGN (5 C2.7)
  - 6 CROSSWALK STRIPING
  - 7 EV CHARGING - SEE ARCHITECTURAL PLANS
  - 8 BIKE RACK, SEE ARCHITECTURAL PLANS
  - 9 DUMPSTER ENCLOSURE, SEE ARCHITECTURAL PLANS

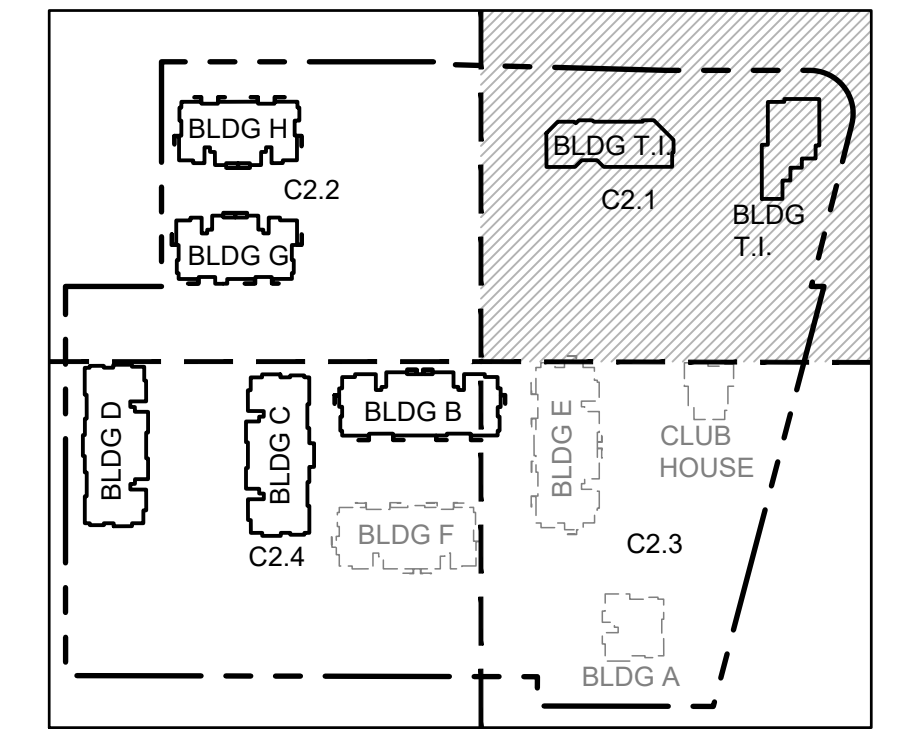

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
**ASH DEVELOPMENT**  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A PROFESSIONAL ENGINEER'S LIABILITY INSURANCE COVERAGE. THIS DOCUMENT IS FOR THE PROJECT IDENTIFIED IN THE TITLE BLOCK AND IS NOT TO BE USED FOR OTHER PROJECTS, IN ADDITION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

- 03/29/24 CITY COMMENTS
  - 01/29/24 CITY COMMENTS
- Revisions:

Sheet Title:  
**HORIZONTAL CONTROL AND PAVING PLAN NW**

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI



Sheet No.  
**C2.1**  
 4 of 53 Sheets





# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

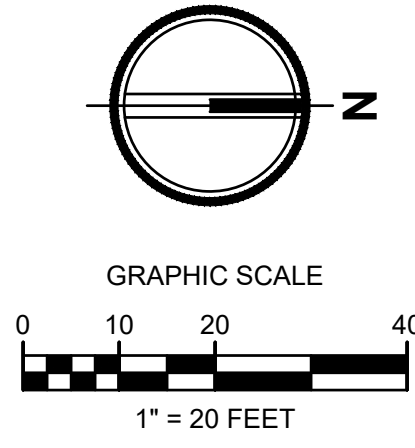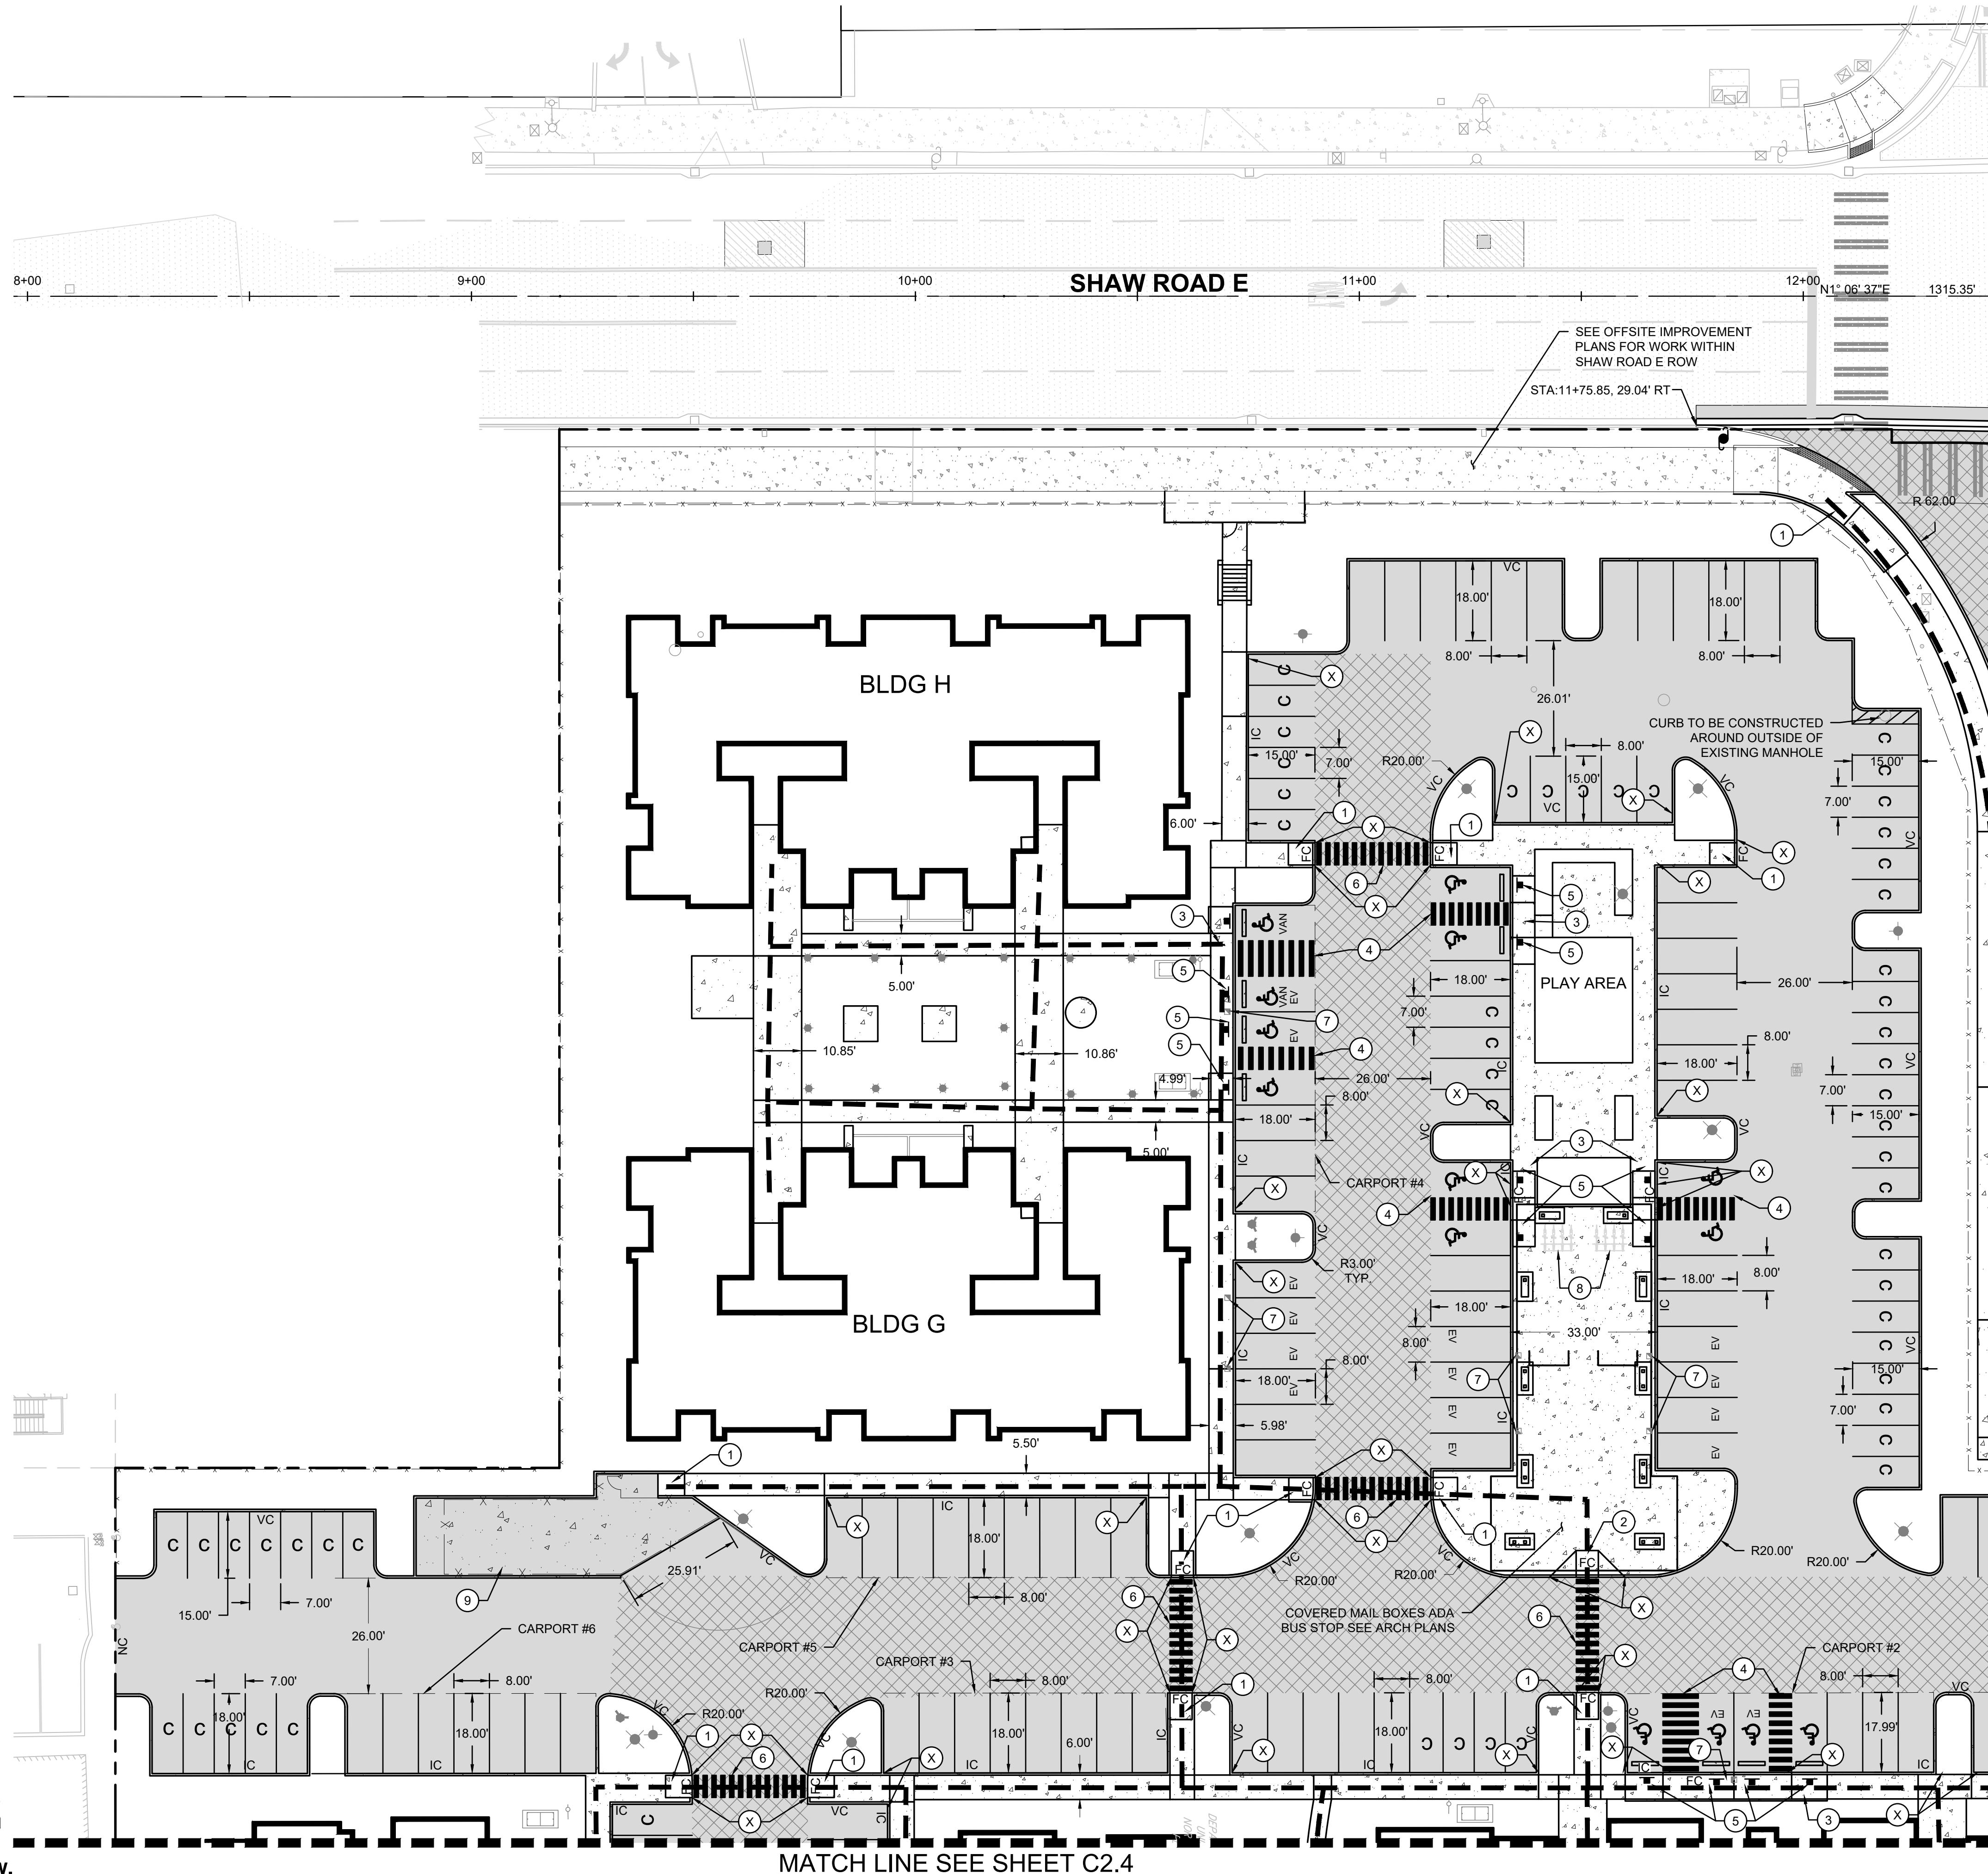


APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.  
 THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.  
 FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.



- LEGEND:**
- RIGHT-OF-WAY/PROPERTY LINE
  - - - CENTERLINE
  - ▬ PROPOSED BUILDING OUTLINE
  - x - x - x FENCING - REFER TO LANDSCAPE ARCHITECTS DRAWINGS.
  - - - ACCESSIBLE PATH
  - ASPHALT PAVEMENT - STANDARD DUTY (1) C2.6
  - ASPHALT PAVEMENT - ATB (2) C2.6
  - PERVIOUS CONCRETE SIDEWALK (3) C2.6
  - CEMENT CONCRETE - HEAVY DUTY (4) C2.6
  - BOLLARD PROTECTION
  - CEMENT CONCRETE WHEEL STOP (7) C2.6
  - ☼ LIGHTING - REFER TO ELECTRICAL PLANS
  - ♿ ADA ACCESSIBLE PARKING STALL (5) C2.7
  - (X) CHANGE IN CURB TYPE / END CURB
  - EC CONCRETE EXTRUDED CURB (5) C2.6
  - IC INTEGRAL CURB AND SIDEWALK (5) C2.6
  - NC NO CURB (8) C2.6
  - CC CURB CUT (6) C2.6
  - VC VERTICAL CURB (6) C2.6
  - CG CONCRETE CURB AND GUTTER
  - FC FLUSH CURB

- KEYNOTES**
- (1) ADA RAMP - SINGLE DIRECTIONAL (1) C2.7
  - (2) ADA RAMP - PERPENDICULAR (3) C2.7
  - (3) ADA RAMP - DEPRESSED SIDEWALK (2) C2.7
  - (4) ADA STALL (5) C2.7
  - (5) ADA SIGN (5) C2.7
  - (6) CROSSWALK STRIPING
  - (7) EV CHARGING - SEE ARCHITECTURAL PLANS
  - (8) BIKE RACK, SEE ARCHITECTURAL PLANS
  - (9) DUMPSTER ENCLOSURE, SEE ARCHITECTURAL PLANS

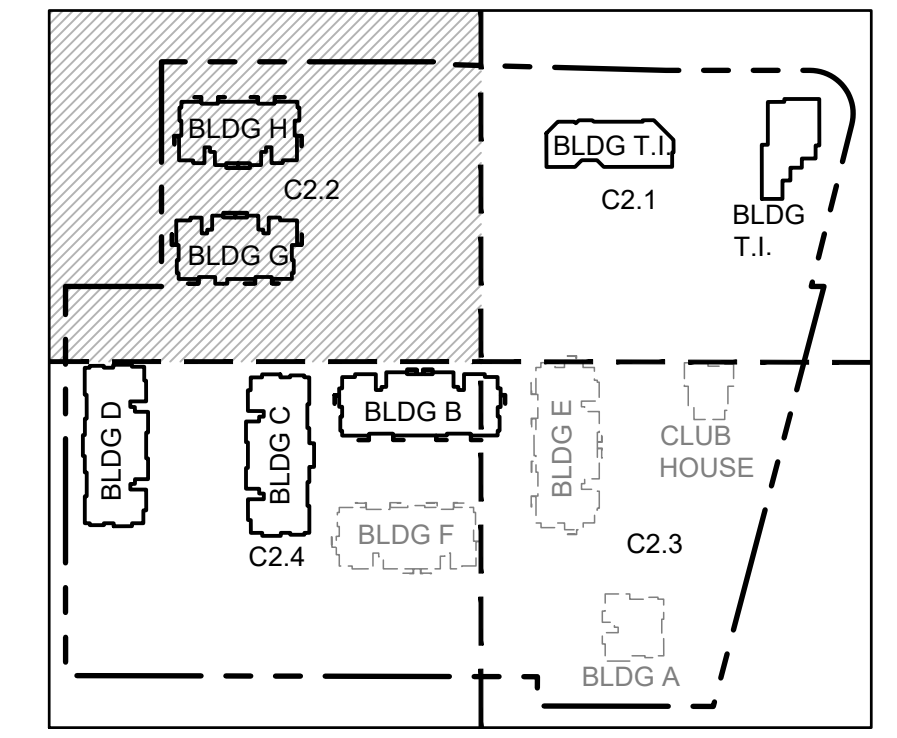

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
**ASH DEVELOPMENT**  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OR WARRANTY BY THE ENGINEER OR ARCHITECT. THE ENGINEER OR ARCHITECT IS NOT TO BE USED FOR OTHER PROJECTS OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

- △ 03/29/24 CITY COMMENTS
  - △ 01/29/24 CITY COMMENTS
- Revisions:

Sheet Title:  
**HORIZONTAL CONTROL AND PAVING PLAN SW**

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C2.2**  
 5 of 53 Sheets




Know what's below.  
 Call before you dig.



# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

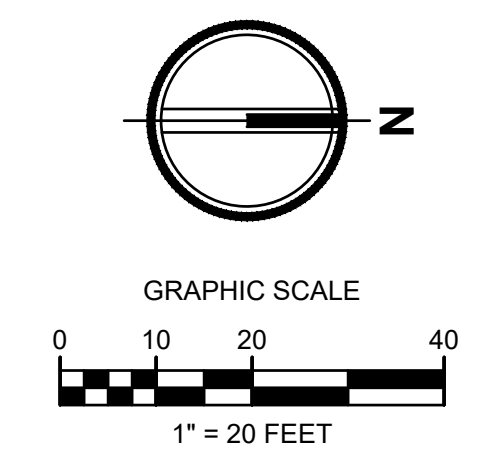

TACOMA · SEATTLE · SPOKANE · TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
**ASH DEVELOPMENT**  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A PROFESSIONAL ENGINEER'S LIABILITY INSURANCE POLICY. THIS DOCUMENT IS FOR THE PROJECT IDENTIFIED IN THE TITLE BLOCK AND IS NOT TO BE USED FOR OTHER PROJECTS OR IN ADDITION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**


Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:  
 03/29/24 CITY COMMENTS  
 01/29/24 CITY COMMENTS

Sheet Title:  
**HORIZONTAL CONTROL AND PAVING PLAN NE**


Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C2.3**  
 6 of 53 Sheets

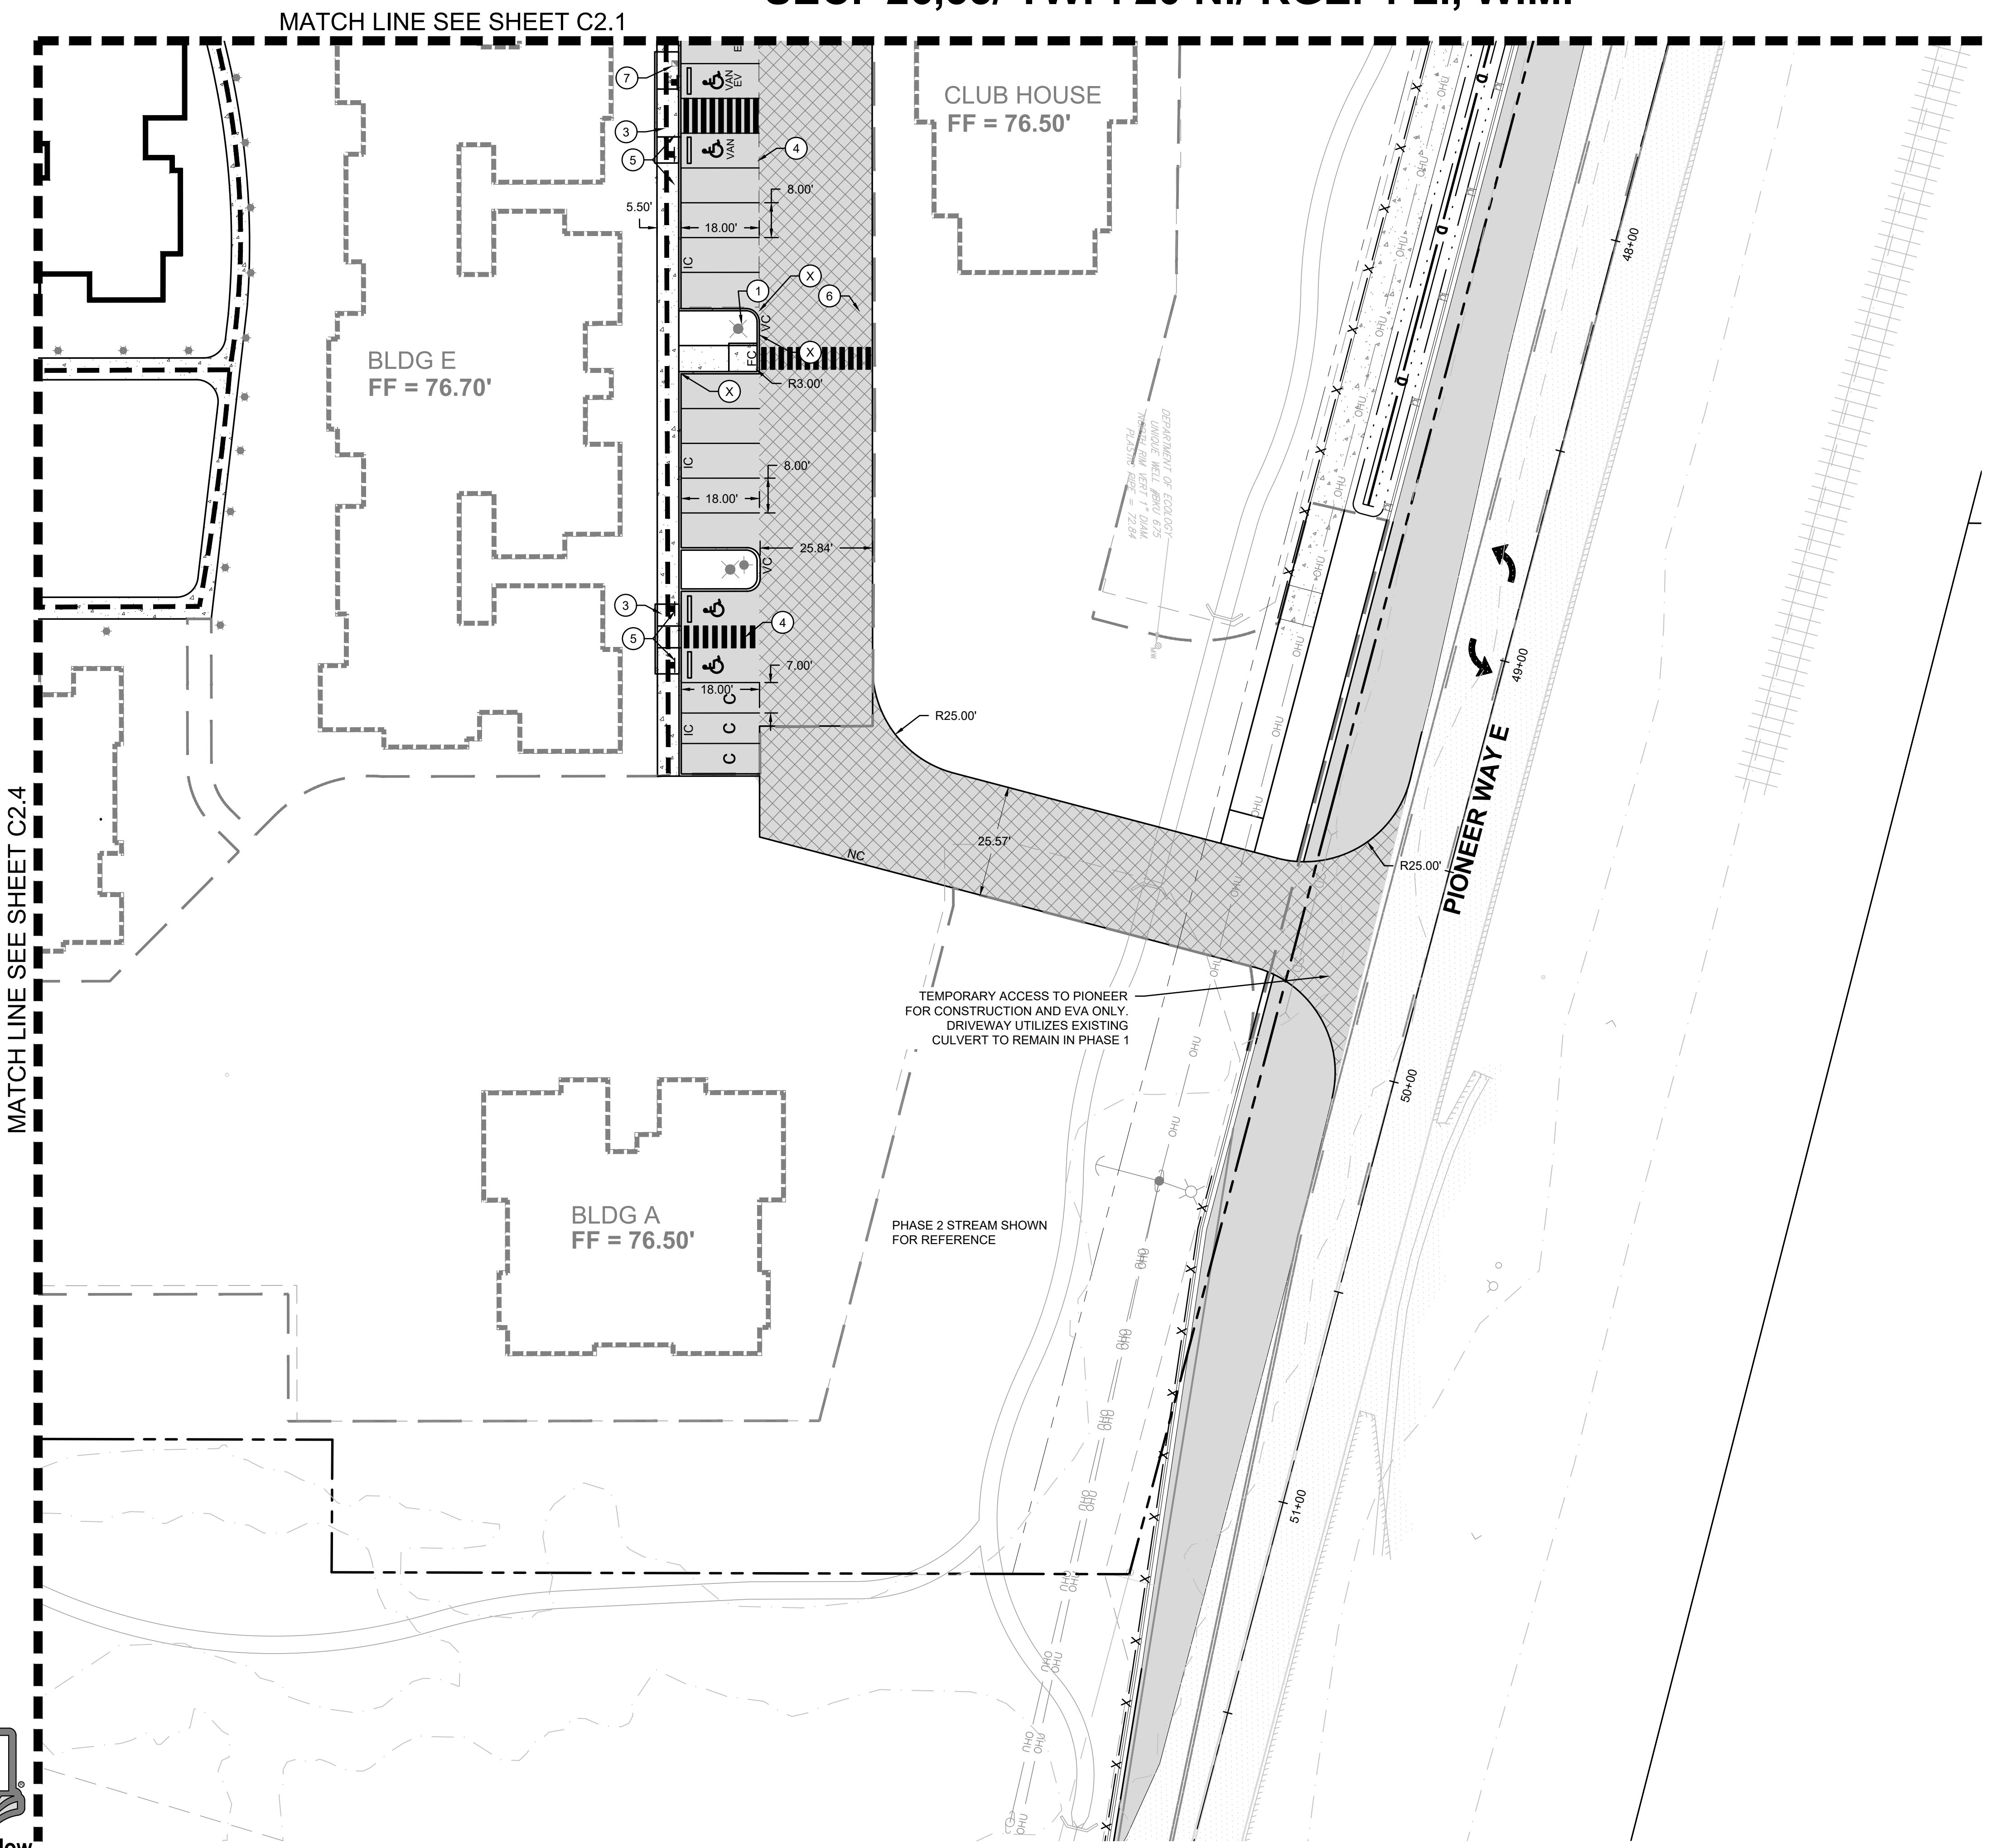

- LEGEND:**
- RIGHT-OF-WAY/PROPERTY LINE
  - CENTERLINE
  - PROPOSED BUILDING OUTLINE
  - - - FENCING - REFER TO LANDSCAPE ARCHITECTS DRAWINGS.
  - - - ACCESSIBLE PATH
  - [Pattern] ASPHALT PAVEMENT - STANDARD DUTY (1 C2.6)
  - [Pattern] ASPHALT PAVEMENT - ATB (2 C2.6)
  - [Pattern] PERVIOUS CONCRETE SIDEWALK (3 C2.6)
  - [Pattern] CEMENT CONCRETE - HEAVY DUTY (4 C2.6)
  - BOLLARD PROTECTION
  - CEMENT CONCRETE WHEEL STOP (7 C2.6)
  - ☼ LIGHTING - REFER TO ELECTRICAL PLANS
  - ♿ ADA ACCESSIBLE PARKING STALL (5 C2.7)
  - (X) CHANGE IN CURB TYPE / END CURB
  - EC CONCRETE EXTRUDED CURB
  - IC INTEGRAL CURB AND SIDEWALK (5 C2.6)
  - NC NO CURB
  - CC CURB CUT (8 C2.6)
  - VC VERTICAL CURB (6 C2.6)
  - CG CONCRETE CURB AND GUTTER
  - FC FLUSH CURB

- KEYNOTES**
- 1 ADA RAMP - SINGLE DIRECTIONAL (1 C2.7)
  - 2 ADA RAMP - PERPENDICULAR (3 C2.7)
  - 3 ADA RAMP - DEPRESSED SIDEWALK (2 C2.7)
  - 4 ADA STALL (5 C2.7)
  - 5 ADA SIGN (5 C2.7)
  - 6 CROSSWALK STRIPING
  - 7 EV CHARGING - SEE ARCHITECTURAL PLANS
  - 8 BIKE RACK, SEE ARCHITECTURAL PLANS
  - 9 DUMPSTER ENCLOSURE, SEE ARCHITECTURAL PLANS

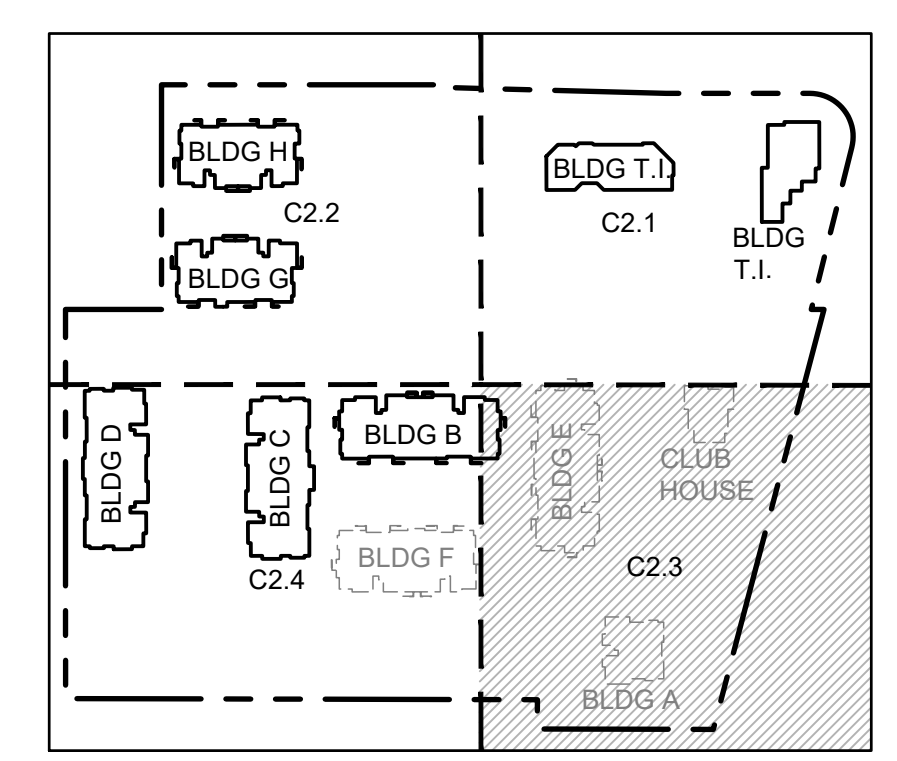

MATCH LINE SEE SHEET C2.4

MATCH LINE SEE SHEET C2.1







# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.


APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

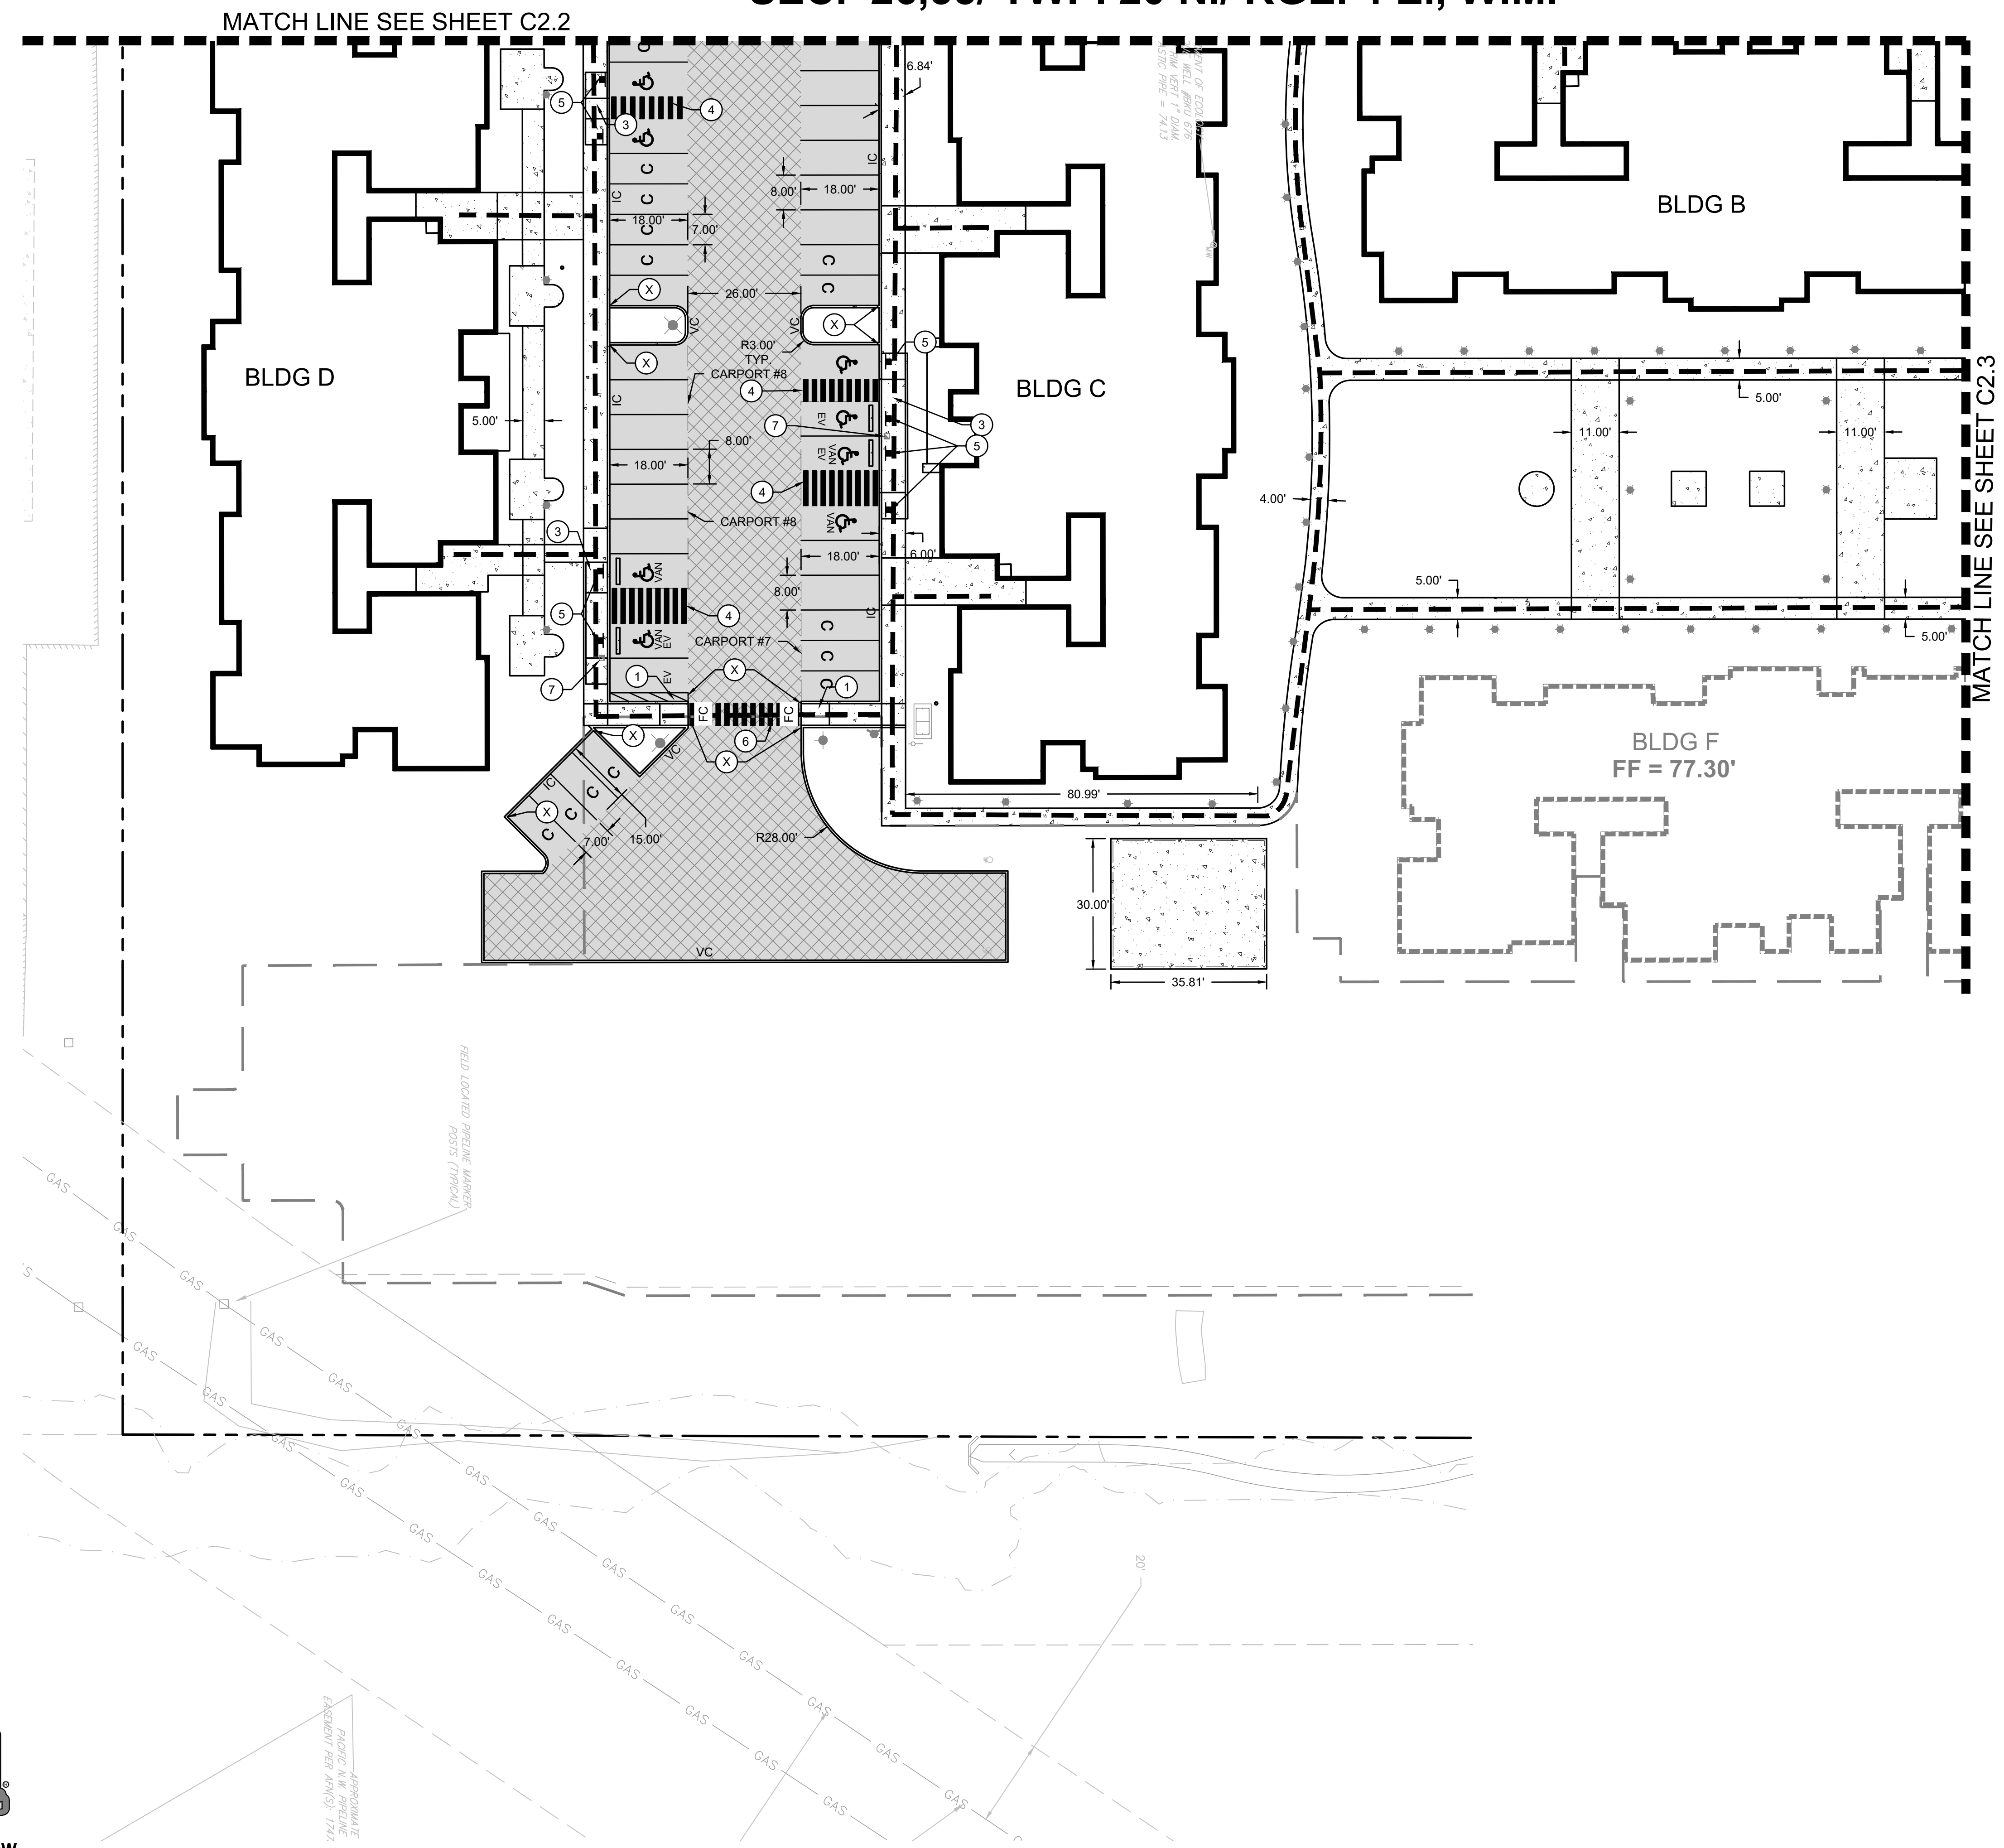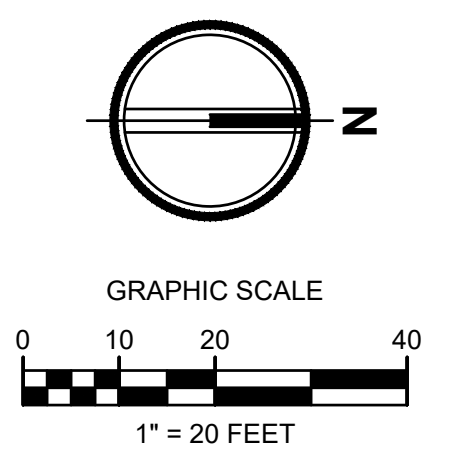

- LEGEND:**
- RIGHT-OF-WAY/PROPERTY LINE
  - CENTERLINE
  - PROPOSED BUILDING OUTLINE
  - - - FENCING - REFER TO LANDSCAPE ARCHITECTS DRAWINGS.
  - - - ACCESSIBLE PATH
  - ASPHALT PAVEMENT - STANDARD DUTY (1) C2.6
  - ASPHALT PAVEMENT - ATB (2) C2.6
  - PERVIOUS CONCRETE SIDEWALK (3) C2.6
  - CEMENT CONCRETE - HEAVY DUTY (4) C2.6
  - BOLLARD PROTECTION
  - CEMENT CONCRETE WHEEL STOP (7) C2.6
  - ★ LIGHTING - REFER TO ELECTRICAL PLANS
  - ♿ ADA ACCESSIBLE PARKING STALL (5) C2.7
  - (X) CHANGE IN CURB TYPE / END CURB
  - EC CONCRETE EXTRUDED CURB (5) C2.6
  - IC INTEGRAL CURB AND SIDEWALK (5) C2.6
  - NC NO CURB (8) C2.6
  - CC CURB CUT (6) C2.6
  - VC VERTICAL CURB (6) C2.6
  - CG CONCRETE CURB AND GUTTER
  - FC FLUSH CURB

- KEYNOTES**
- (1) ADA RAMP - SINGLE DIRECTIONAL (1) C2.7
  - (2) ADA RAMP - PERPENDICULAR (3) C2.7
  - (3) ADA RAMP - DEPRESSED SIDEWALK (2) C2.7
  - (4) ADA STALL (5) C2.7
  - (5) ADA SIGN (5) C2.7
  - (6) CROSSWALK STRIPING
  - (7) EV CHARGING - SEE ARCHITECTURAL PLANS
  - (8) BIKE RACK, SEE ARCHITECTURAL PLANS
  - (9) DUMPSTER ENCLOSURE, SEE ARCHITECTURAL PLANS

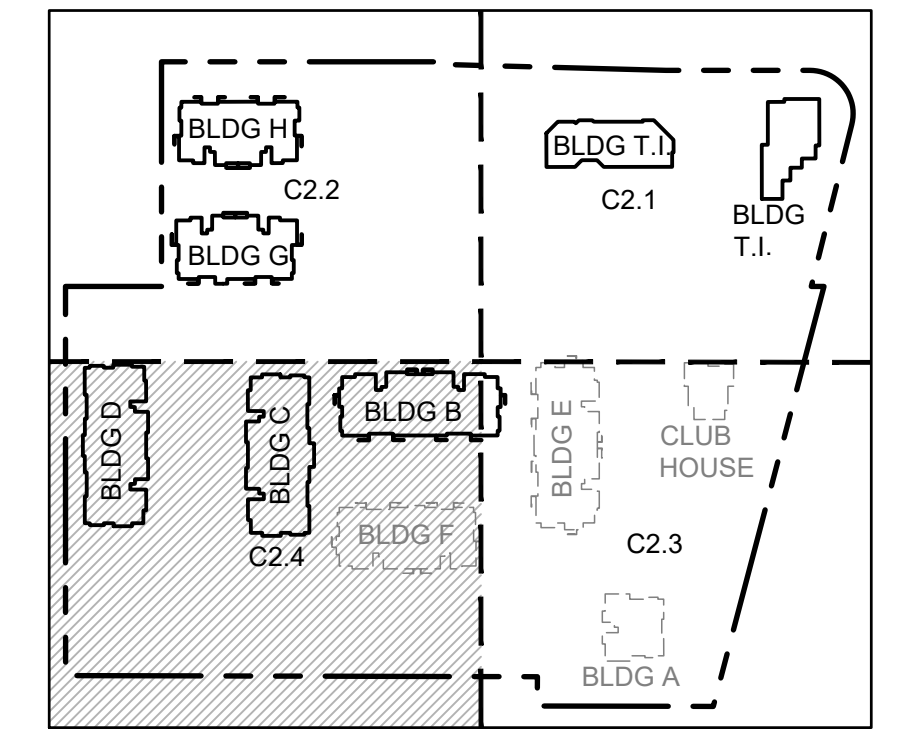

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

Greg HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PUBLICATION OF THE DOCUMENT. THIS IS THE SOLE PROPERTY OF THE ENGINEER. NO PART OF THIS DOCUMENT OR THE CONTENTS HEREIN SHALL BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF THE ENGINEER.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:

- 03/29/24 CITY COMMENTS
- 01/29/24 CITY COMMENTS

Sheet Title:  
**HORIZONTAL CONTROL AND PAVING PLAN SE**

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C2.4**  
 7 of 53 Sheets





# EAST TOWN CROSSING PHASE 1


## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED

BY: *[Signature]*  
CITY OF PUYALLUP  
DEVELOPMENT ENGINEERING

DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

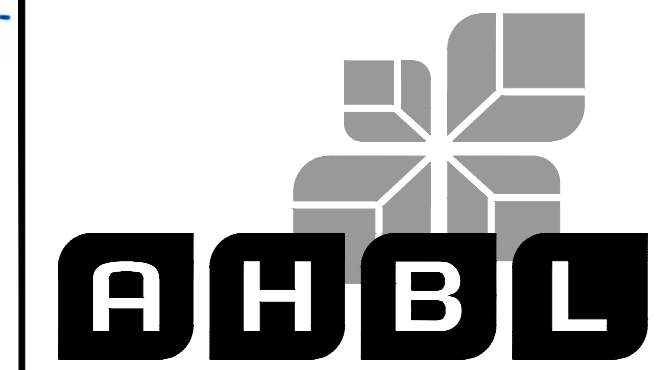


TACOMA · SEATTLE · SPOKANE · TRI-CITIES  
2215 North 30th Street, Suite 300, Tacoma, WA 98403  
253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
ASH DEVELOPMENT  
  
GREG HELLE  
GREG.HELLE@ASHNW.COM

Project No.  
2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
05/17/2024

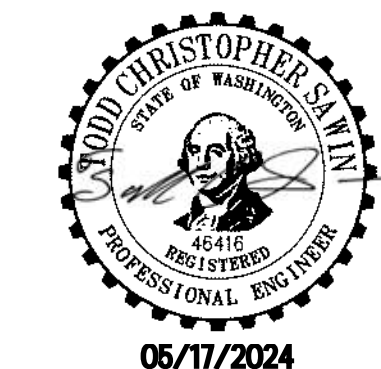

NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OR WARRANTY. THE ENGINEER OR ARCHITECT ASSUMES NO LIABILITY FOR THE PROJECT EXCEPT IN THE TITLE BLOCK AND IS NOT TO BE USED FOR OTHER PROJECTS OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

- △ 03/29/24 CITY COMMENTS
  - △ 01/29/24 CITY COMMENTS
- Revisions:



Sheet Title:  
**FIRE LANE AND SIGNAGE PLAN**

Designed by: CW  
Drawn by: SK / RS  
Checked by: JI

Sheet No.  
**C2.5**  
8 of 53 Sheets

SHAW ROAD EAST

PIONEER WAY EAST

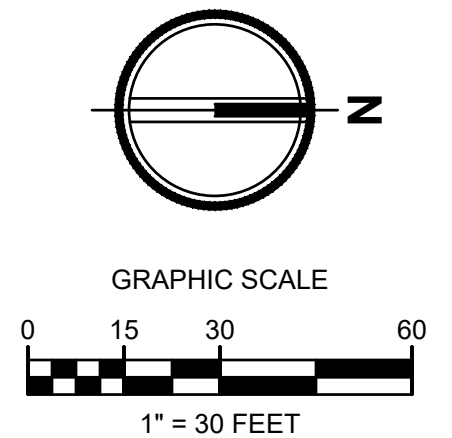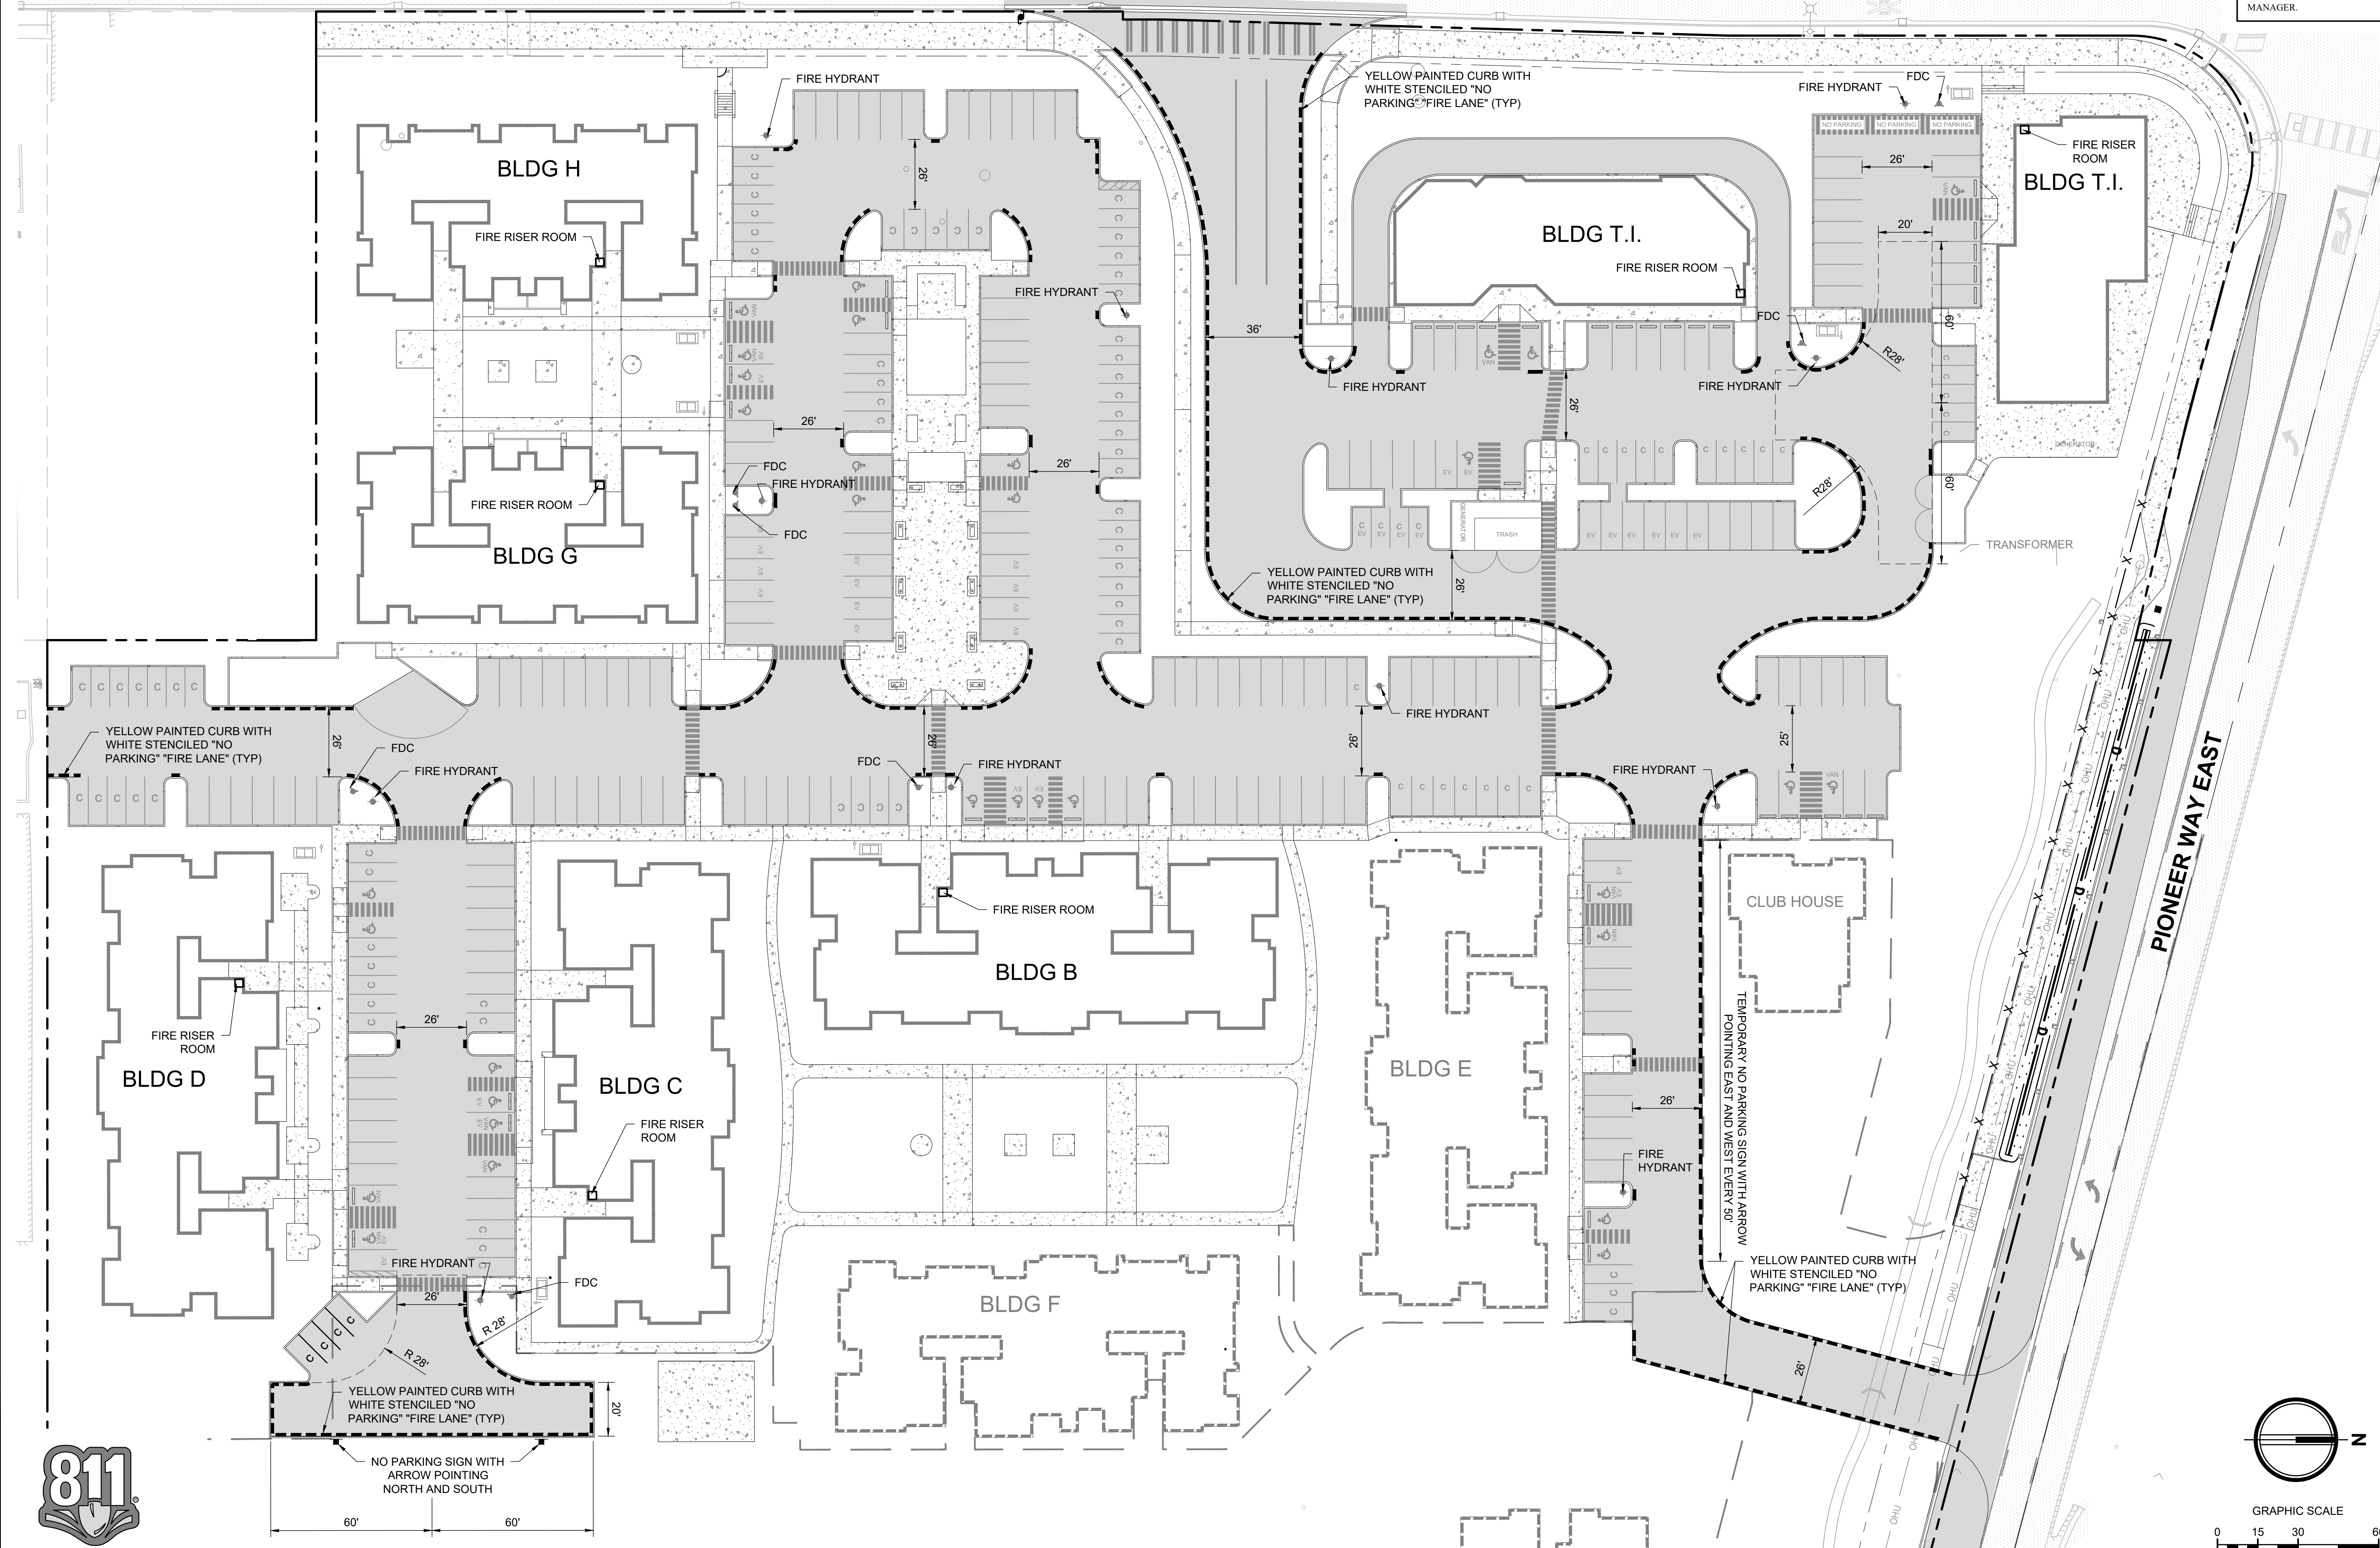








# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

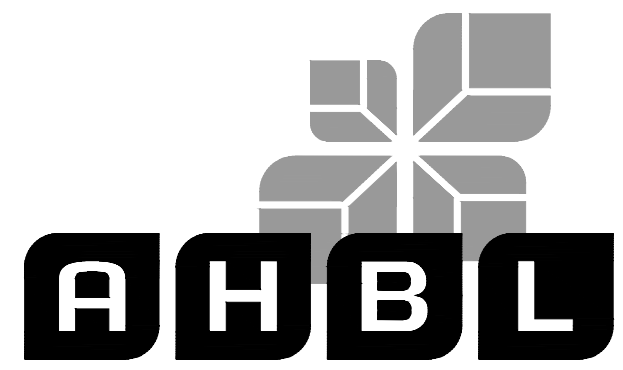

TACOMA · SEATTLE · SPOKANE · TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL. 253.383.2572 FAX www.ahbl.com WEB

Project Title:  
**EAST TOWN CROSSING PHASE 1**  
 Client:  
 ASH DEVELOPMENT  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752  
 Issue Set & Date:  
 PERMIT SUBMITTAL  
 05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A PROFESSIONAL ENGINEER'S RESPONSIBILITY TO THE ORIGINAL OWNER. THIS DOCUMENT IS NOT TO BE USED FOR OTHER PROJECTS OR FOR ANY OTHER PURPOSE.





City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:  
 03/29/24 CITY COMMENTS  
 01/29/24 CITY COMMENTS


Sheet Title:  
**PAVING NOTES AND DETAILS**  
 Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C2.7**  
 10 of 53 Sheets

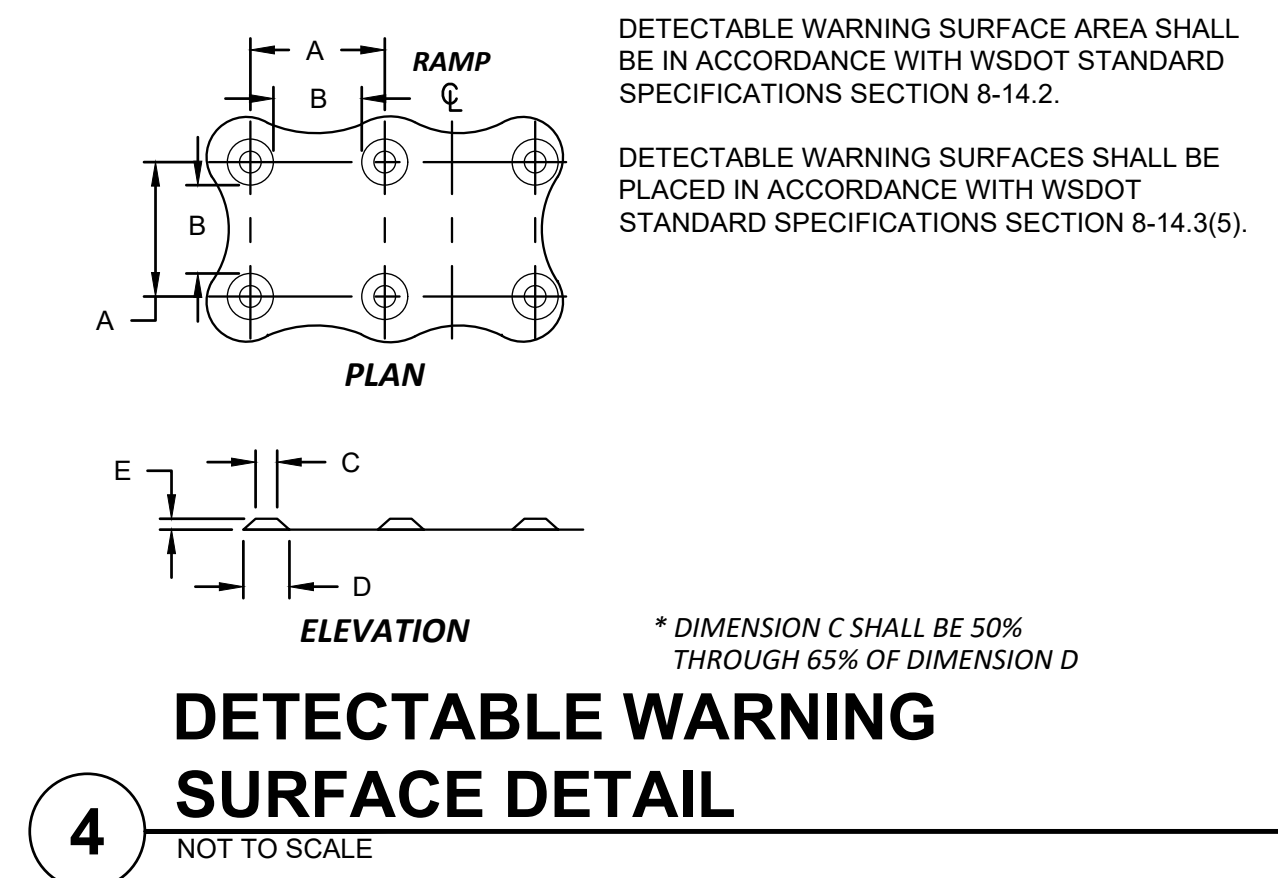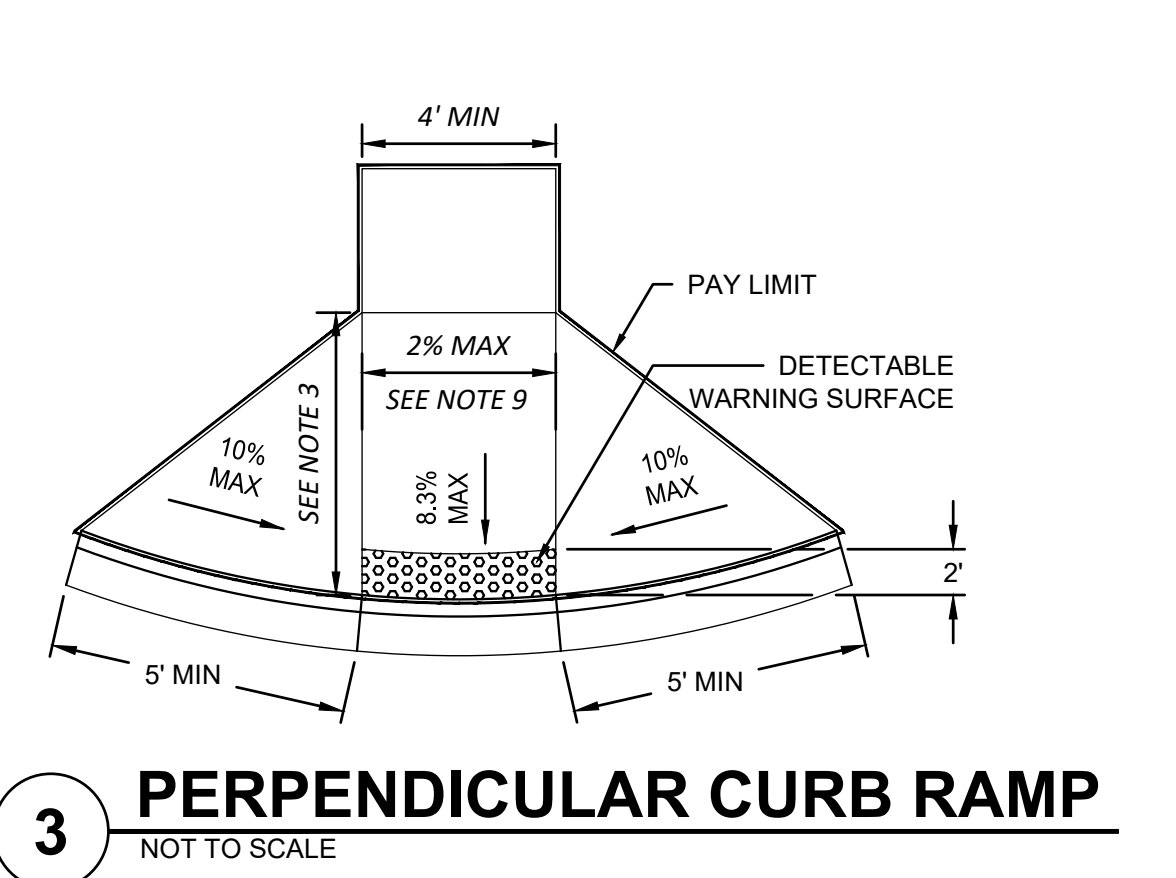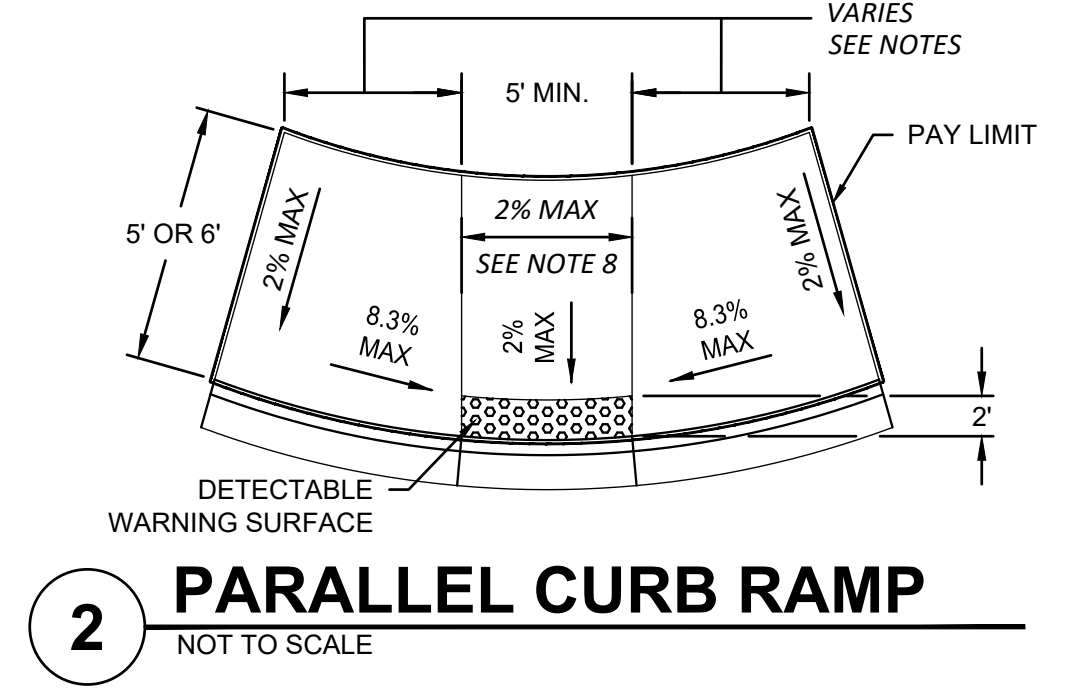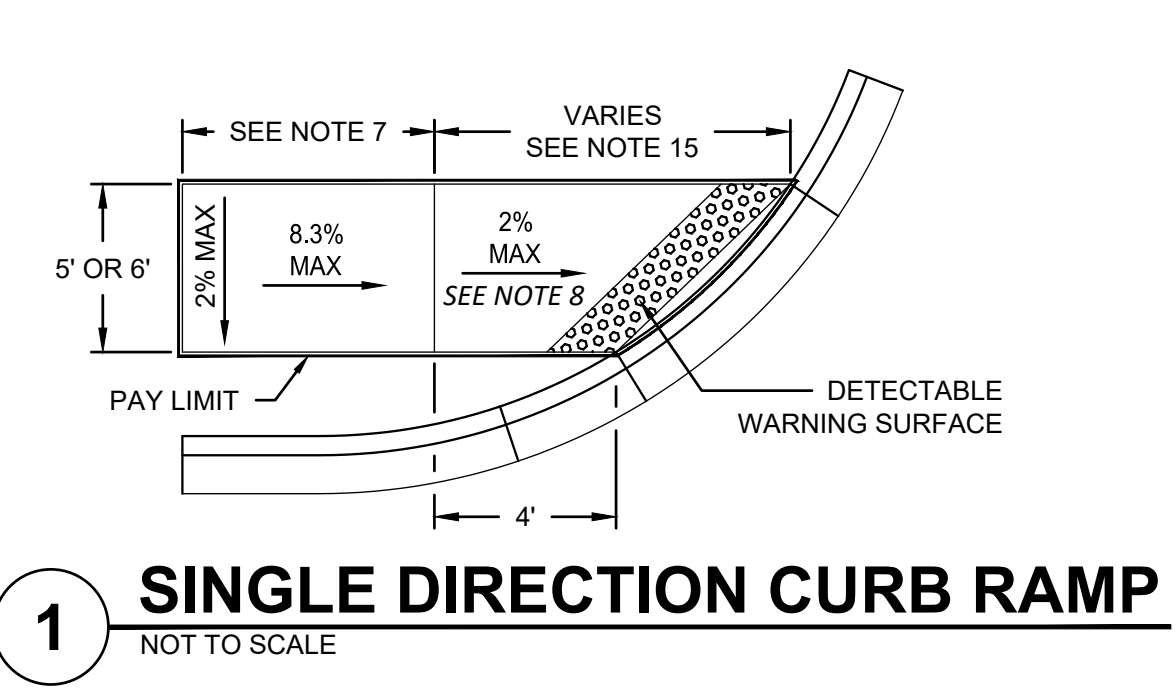

### CURB RAMP NOTES:

- CURB RAMP ARE TYPICALLY CENTERED AT THE 1/4 RADIUS POINTS.
- CURB TO BE FLUSH WITH ADJACENT ROADWAY SURFACE. THE BID ITEM DOES NOT INCLUDE THE CURB AND GUTTER.
- PERPENDICULAR RAMP LENGTH IS MEASURED FROM BACK OF CURB.
- PARALLEL RAMP LENGTHS VARY FROM 6' MIN. TO 15' MAX.
- IF SIGNAL POLE EXISTS, PARALLEL CURB RAMP SHALL INCLUDE THE CONCRETE AREA AROUND THE SIGNAL POLE. SIDEWALK DEPTH SHALL BE 6" FROM PC TO PT. SEE STANDARD DRAWING PC.J1.2 FOR ADDITIONAL DETAILS.
- ADJUST RAMP LENGTHS TO MEET ADA REQUIREMENTS 8.3% MAX GRADE, 15' MAX LENGTH.
- SEE WSDOT STANDARD PLAN F-40.16-03 NOTE 8.
- LANDINGS SHALL HAVE A 2% MAX. GRADE IN EACH DIRECTION, EXCEPT AT MIDBLOCK CROSSINGS WHERE THEY MAY MATCH THE GRADE OF THE ROADWAY.
- PERPENDICULAR CURB RAMP SHALL HAVE A 2% MAX. CROSS SLOPE, EXCEPT AT MIDBLOCK CROSSINGS WHERE IT MAY MATCH THE GRADE OF THE ROADWAY.
- THE ROWS OF TRUNCATED DOMES IN DETECTABLE WARNING SURFACES SHALL BE ALIGNED PERPENDICULAR TO THE GRADE BREAK AT THE BACK OF CURB.
- CURB RAMP CANNOT BE PERVIOUS MATERIAL.
- SEE THE CURRENT EDITION OF WSDOT STANDARD PLAN F-10.12 FOR PEDESTRIAN CURB DETAILS.
- FOR RESIDENTIAL DRIVEWAY APPROACHES PARALLEL CURB RAMP SHALL BE 2' MIN. FROM THE DRIVEWAY APPROACH.
- TO AVOID OBSTACLES, CURB RAMP OPPOSITE THE RETURNED CURBS AT "T" INTERSECTIONS MAY BE PLACED AT A SKEW OF 5° MAX FROM AN ALIGNMENT PERPENDICULAR TO THE CENTERLINE
- IF DISTANCE IS LESS THAN 5 FT BETWEEN LANDING AND BACK OF CURB, THE DETECTABLE WARNING STRIP SHALL BE PLACED AT THE BOTTOM OF THE RAMP.

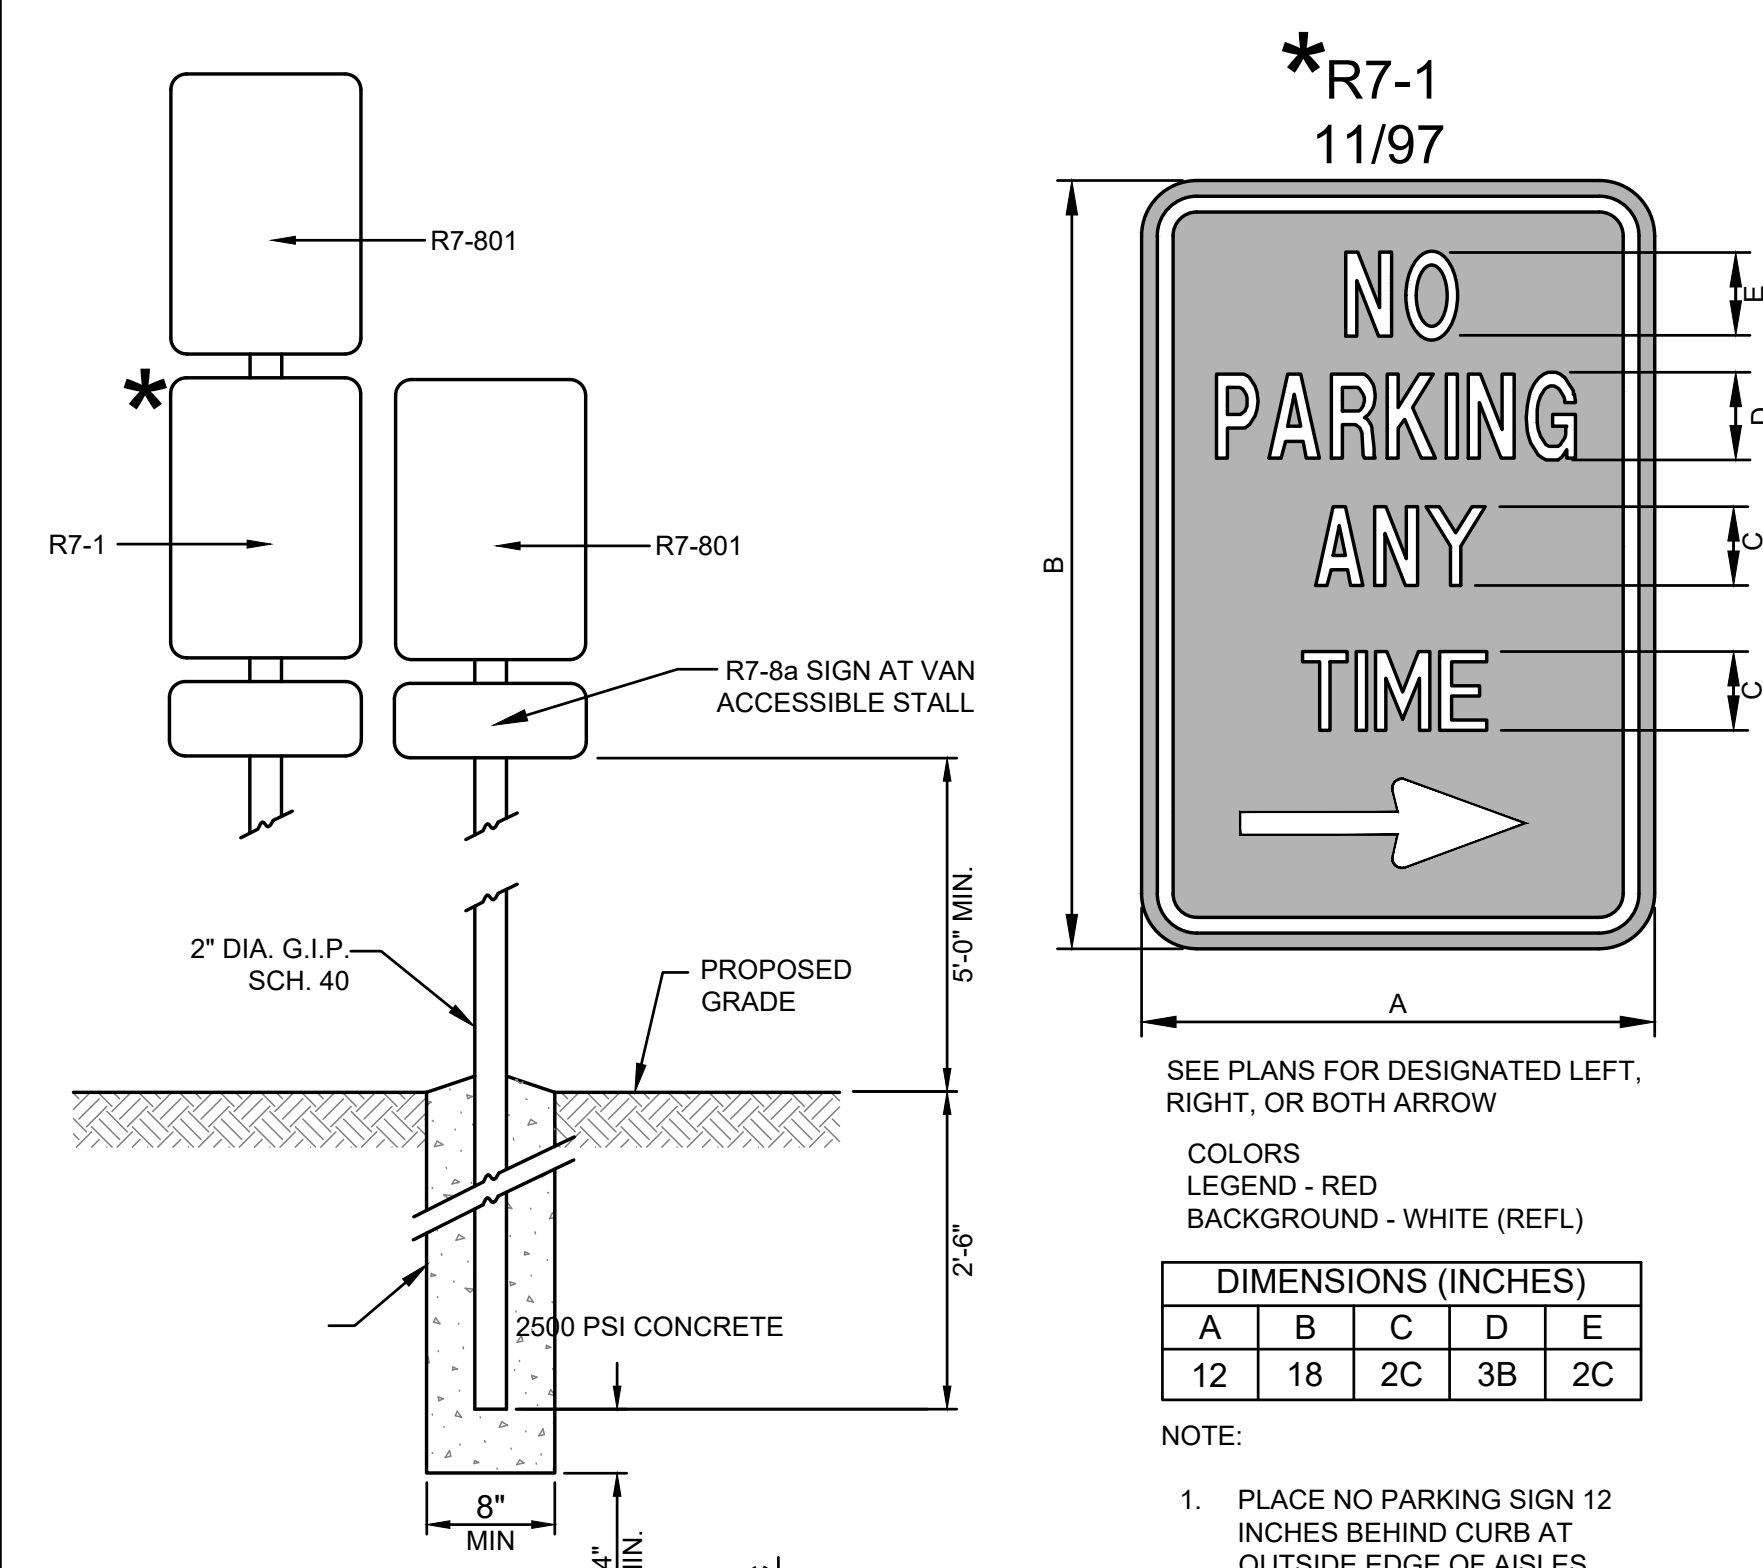

**\*R7-1**  
 11/97

**NO PARKING ANY TIME**

SEE PLANS FOR DESIGNATED LEFT, RIGHT, OR BOTH ARROW

COLORS  
 LEGEND - RED  
 BACKGROUND - WHITE (REFL)

DIMENSIONS (INCHES)				
A	B	C	D	E
12	18	2C	3B	2C

NOTE:  
 1. PLACE NO PARKING SIGN 12 INCHES BEHIND CURB AT OUTSIDE EDGE OF AISLES


**R7-801**  
 12/08

**PARKING**

COLORS  
 LEGEND & BORDER - WHITE (REFL)  
 SYMBOL - WHITE (REFL)  
 BACKGROUND - BLUE (REFL)

DIMENSIONS (INCHES)								
A	B	C	D	E	F	G	H	J
12	18	3/8	3/8	2 1/2	2C	2	9	1 1/2


NOTE:  
 1. PROVIDE VAN ACCESSIBLE STALL SIGN ON STALLS IDENTIFIED AS VAN STALLS.  
 2. PLACE NO PARKING SIGN 12 INCHES BEHIND CURB AT OUTSIDE EDGE OF AISLES  
 3. PROVIDE NO PARKING SIGN ON STALL POST IF AISLE LEADS TO RAMP

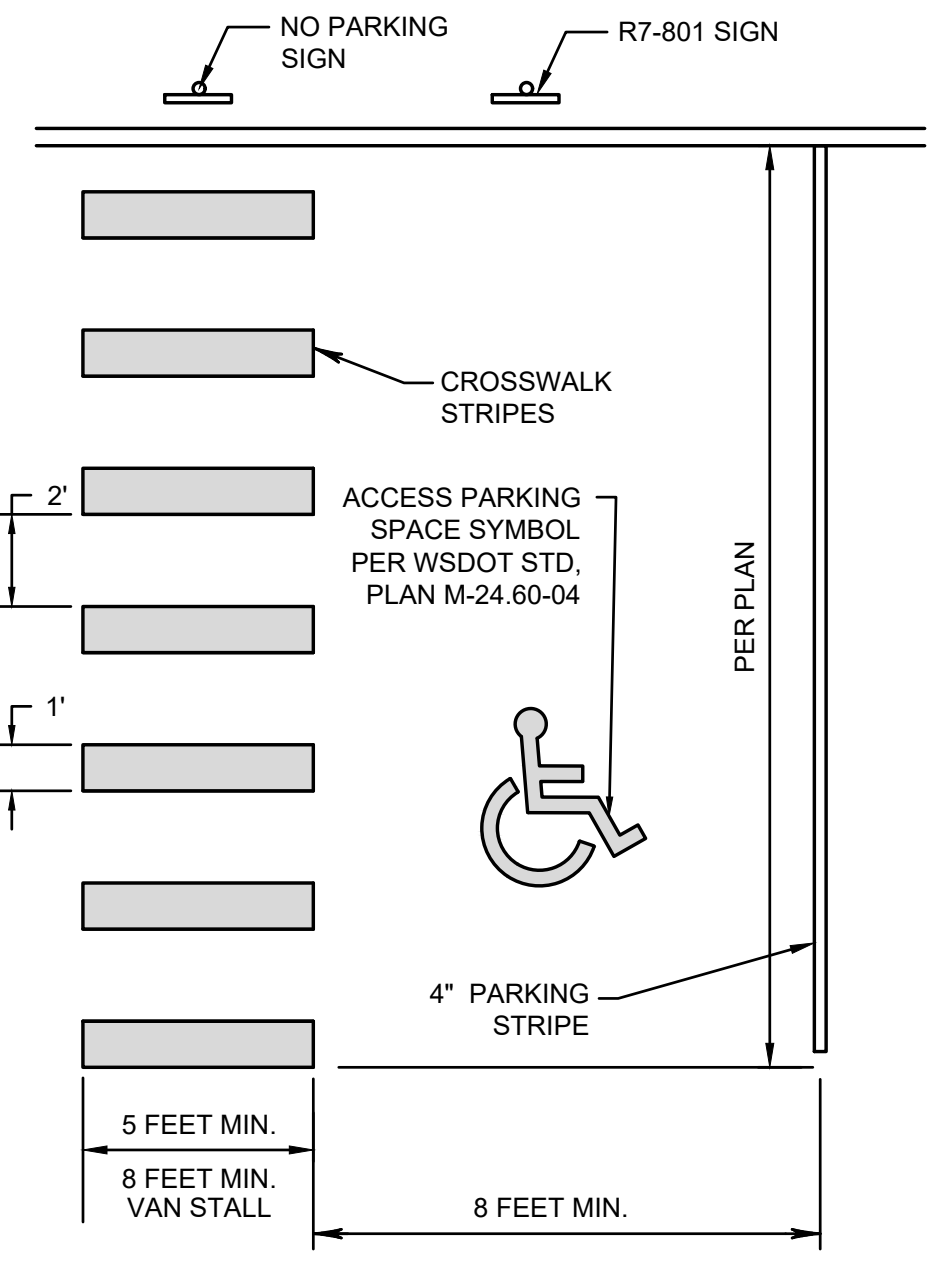



# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

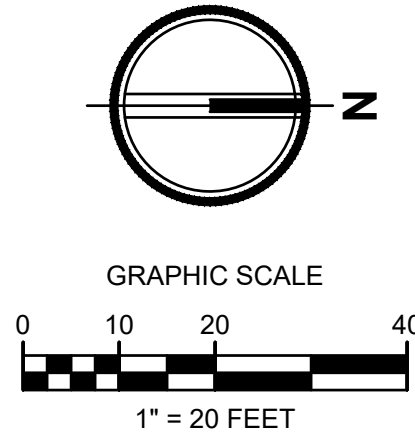

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.



Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752  
 Issue Set & Date:  
 PERMIT SUBMITTAL  
 05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A WARRANTY. CHECKING PROFESSIONALS ARE THE SOLE GUARANTY FOR THE ONLY FOR THE PROJECT. ENGINEERS IN THE TITLE BLOCK ARE NOT TO BE USED FOR OTHER PROJECTS OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**



Building	Planning
Engineering	Public Works
Fire	Traffic

- 03/29/24 CITY COMMENTS
  - 01/29/24 CITY COMMENTS
- Revisions:

Sheet Title:  
**GRADING PLAN NW**

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C3.01**  
 11 of 53 Sheets

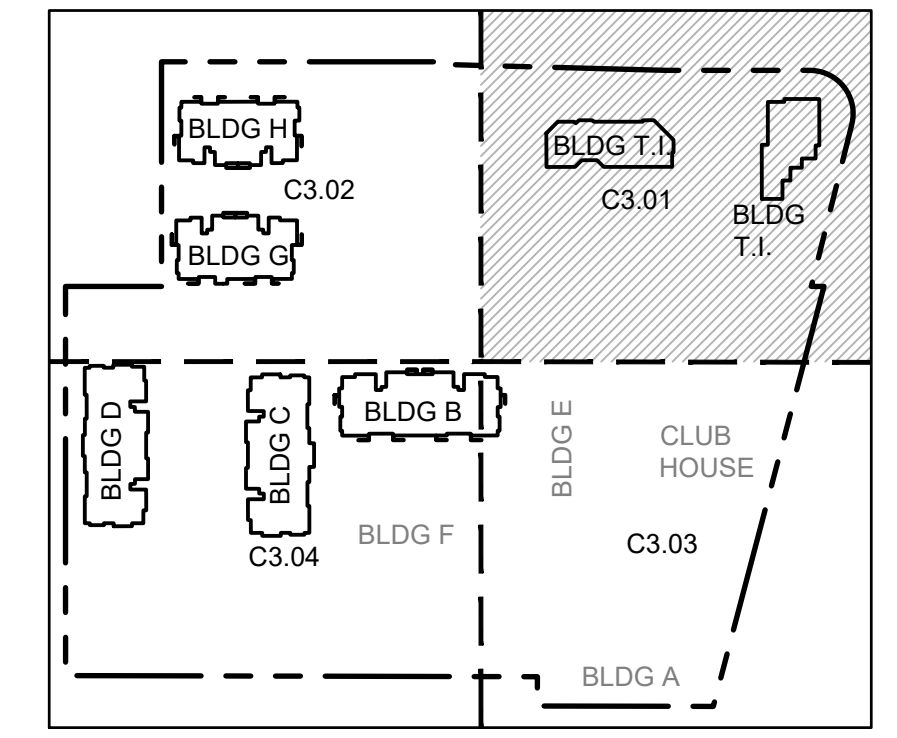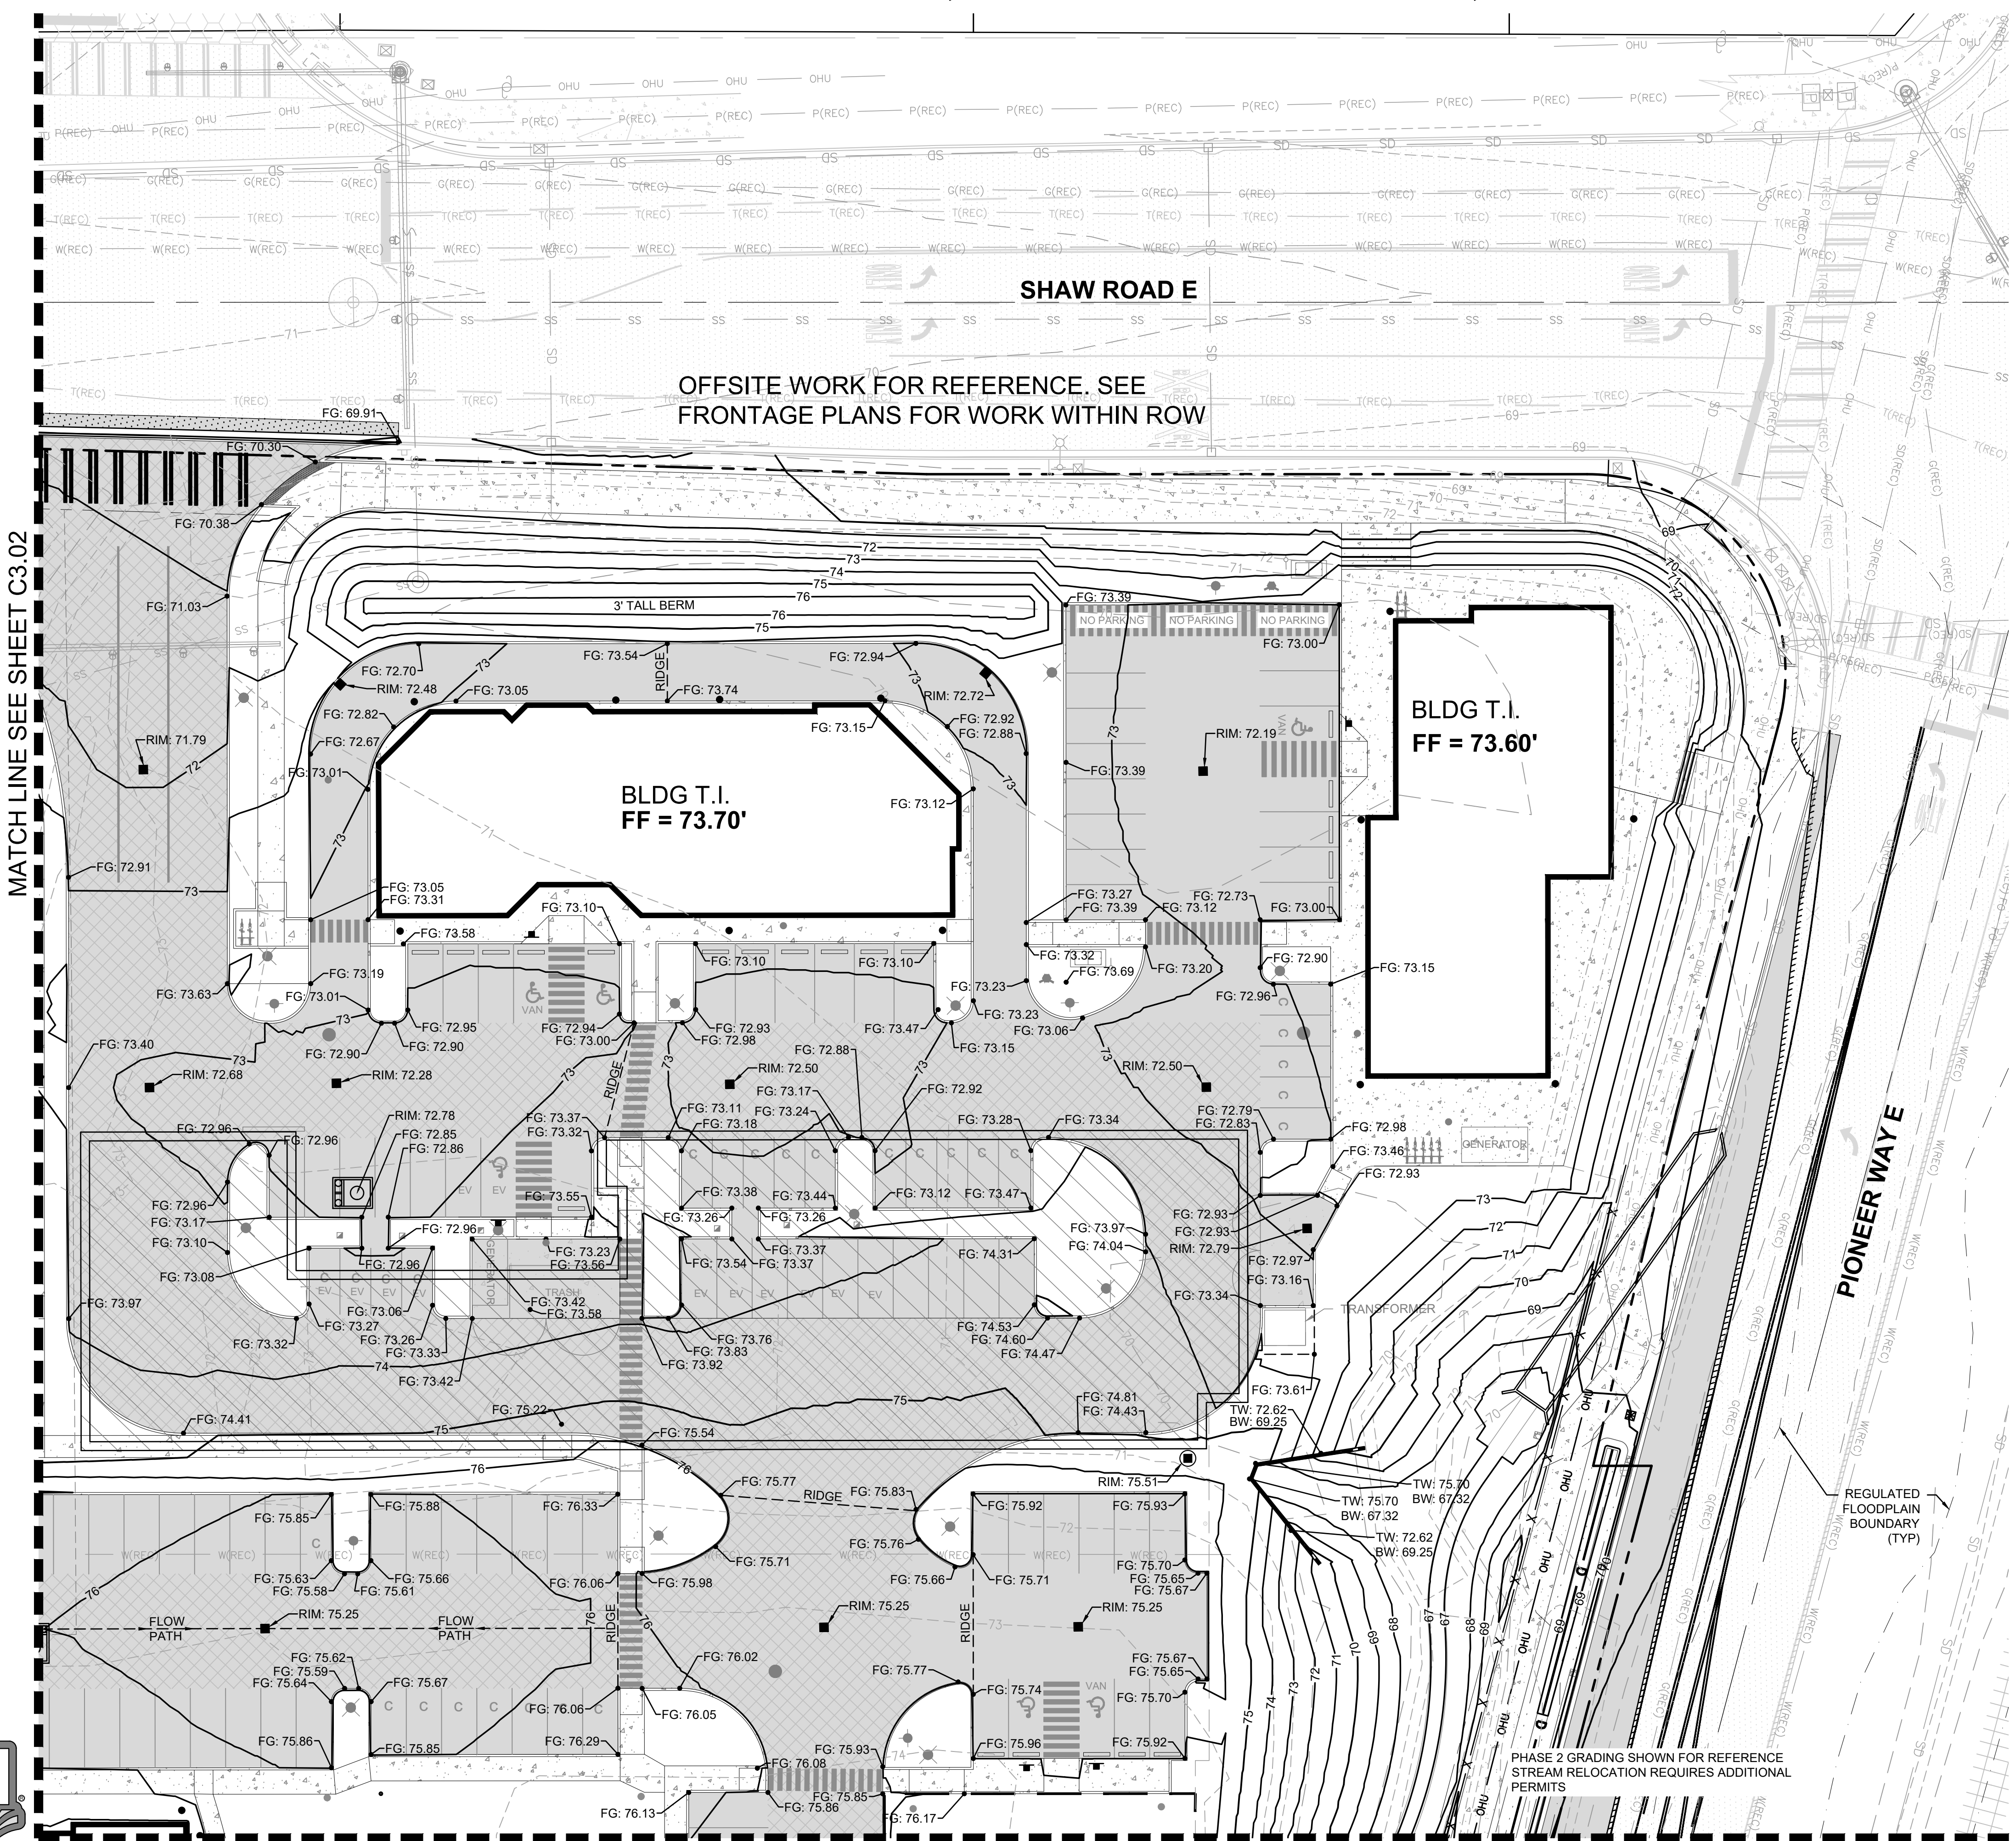

Know what's below.  
 Call before you dig.



MATCH LINE SEE SHEET C3.03

MATCH LINE SEE SHEET C3.02



# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

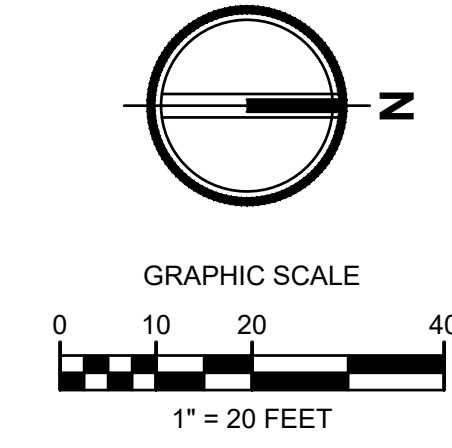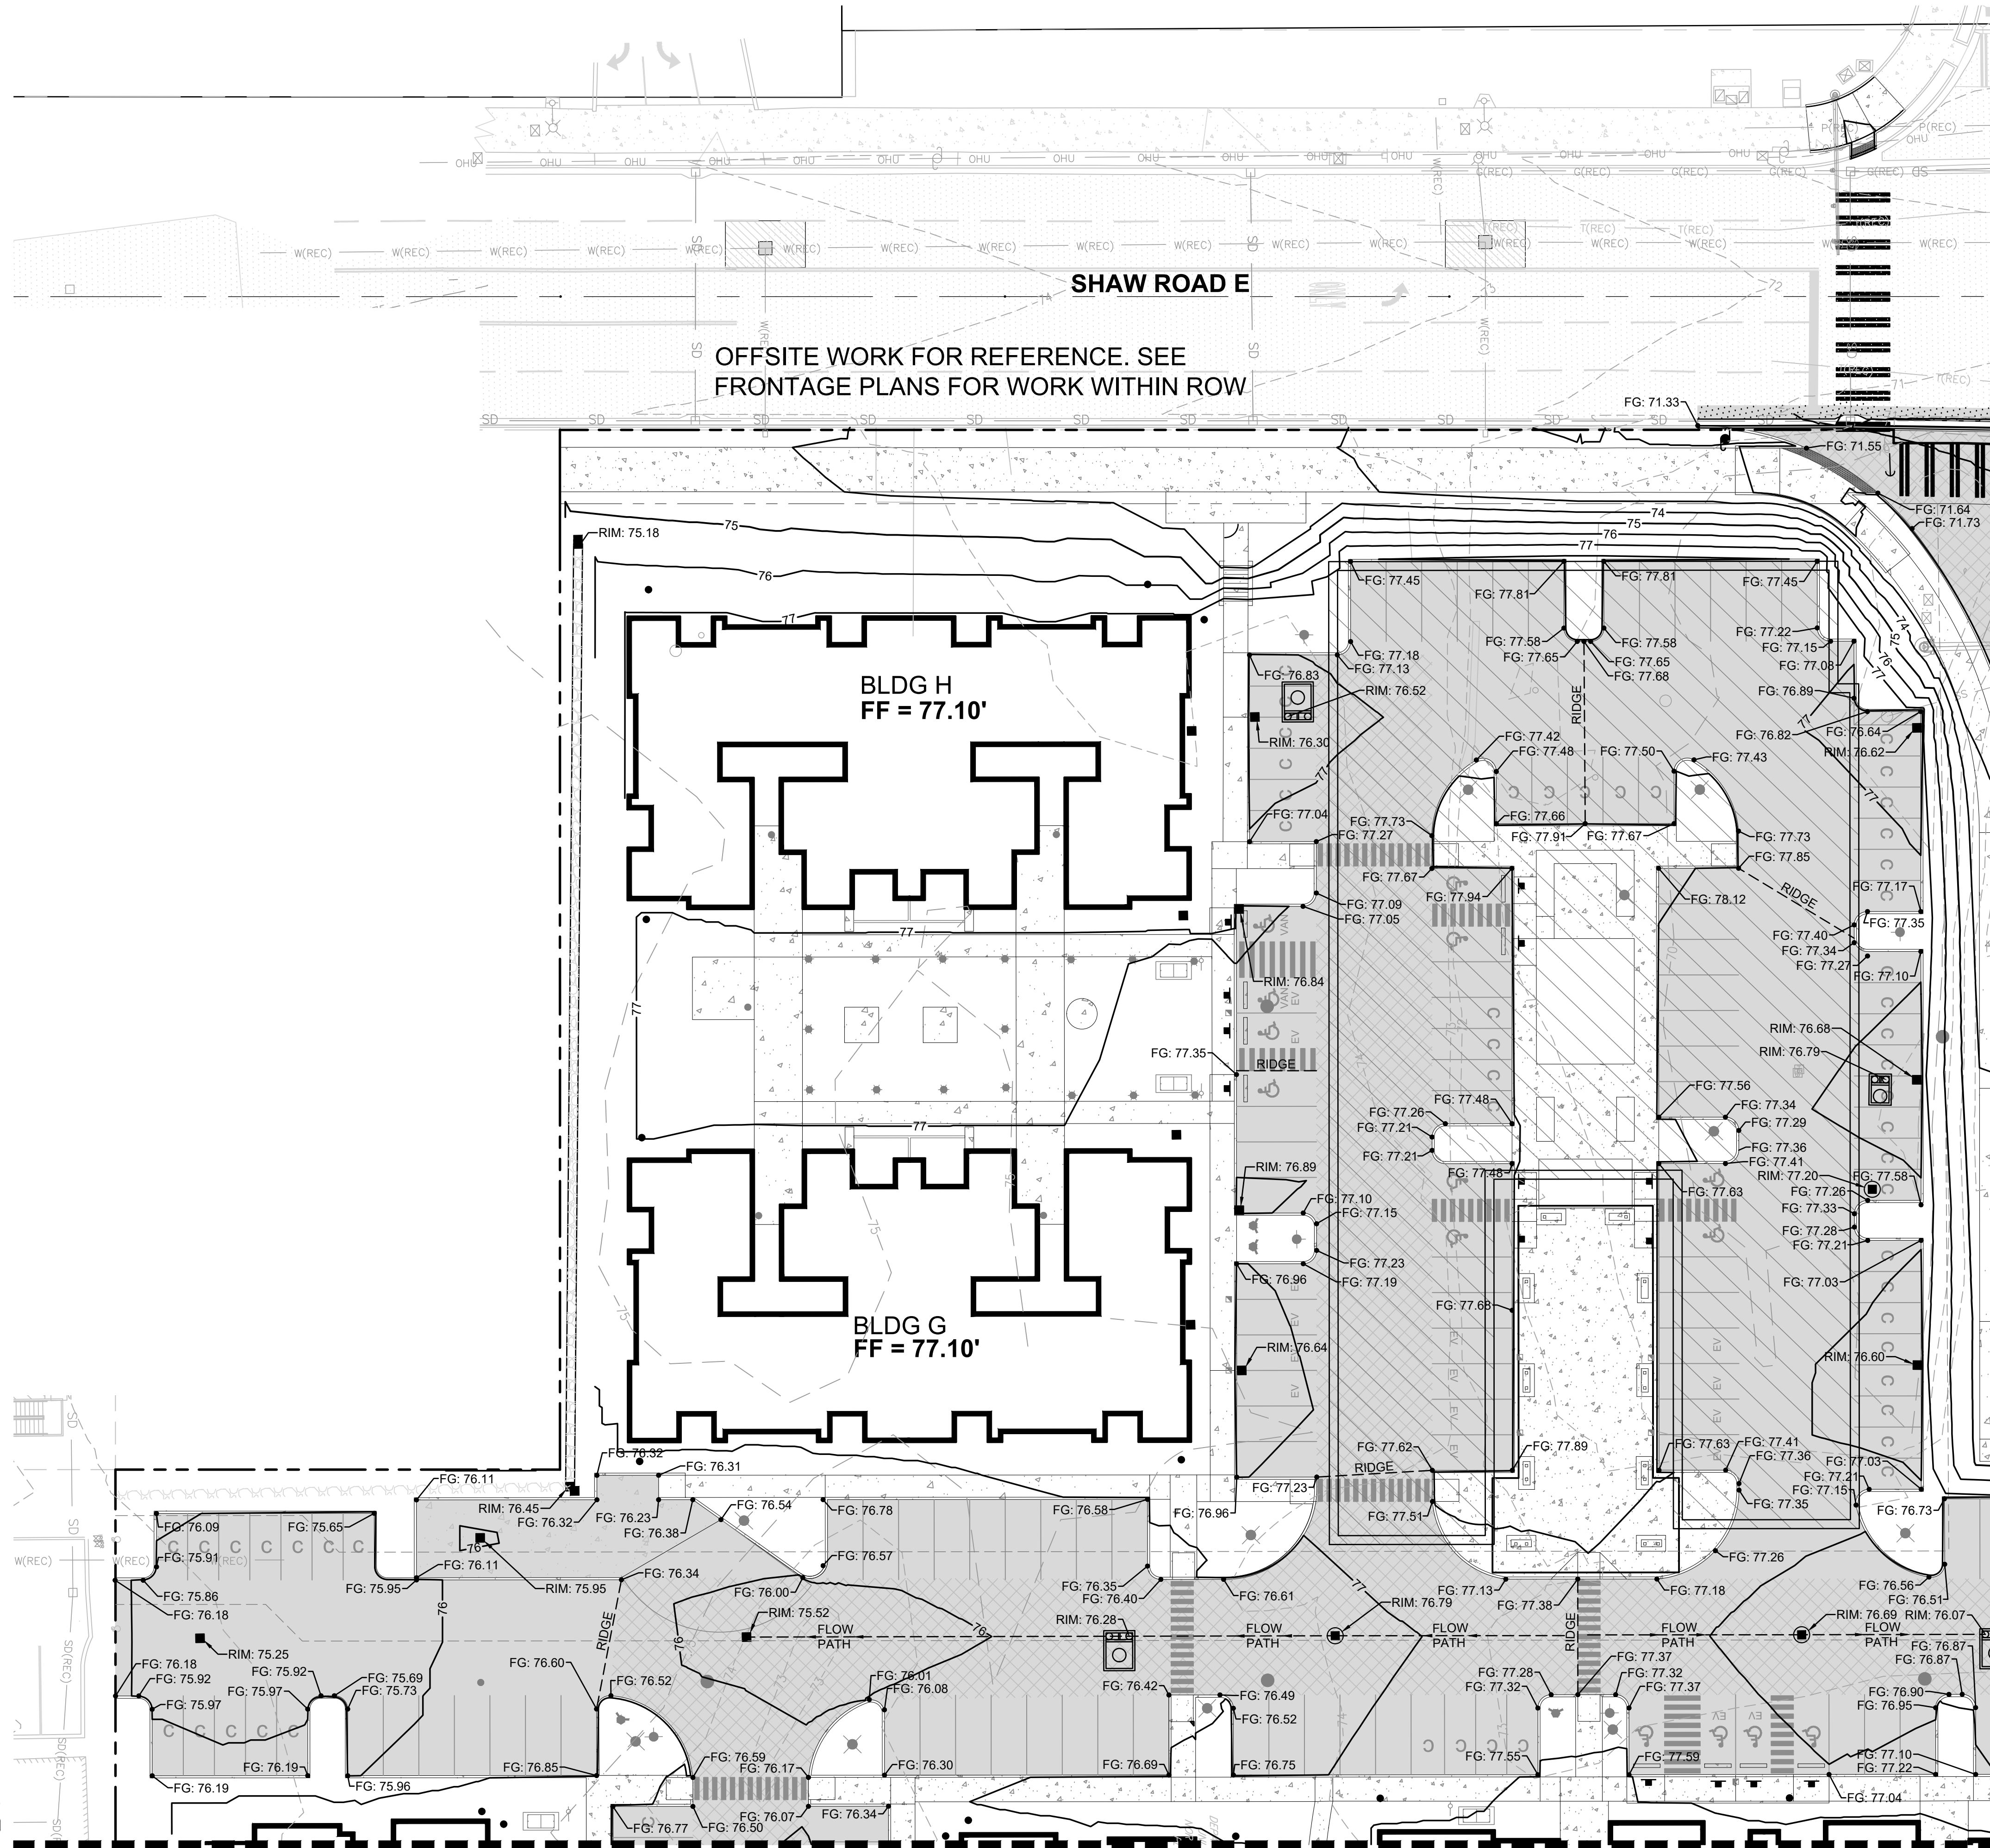

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.



Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OF ACCURACY. THE USER SHALL BE RESPONSIBLE FOR VERIFYING THE DATA AND INFORMATION PROVIDED IN THIS BLOCK AND NOT TO BE USED FOR OTHER PURPOSES OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.


City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

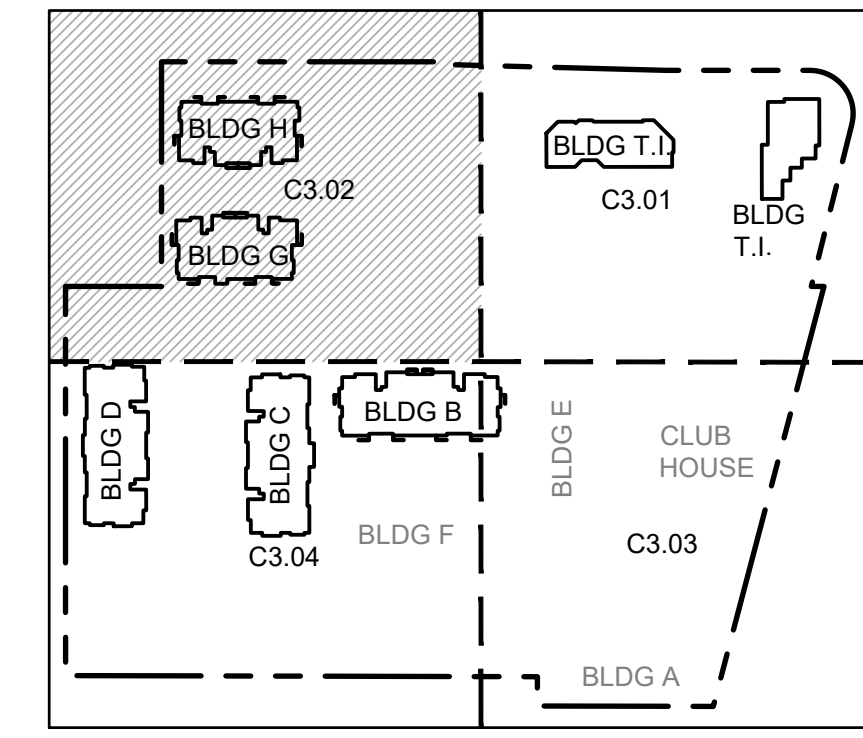

MATCH LINE SEE SHEET C3.04

### GRADING PLAN SW

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C3.02**  
 12 of 53 Sheets




# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

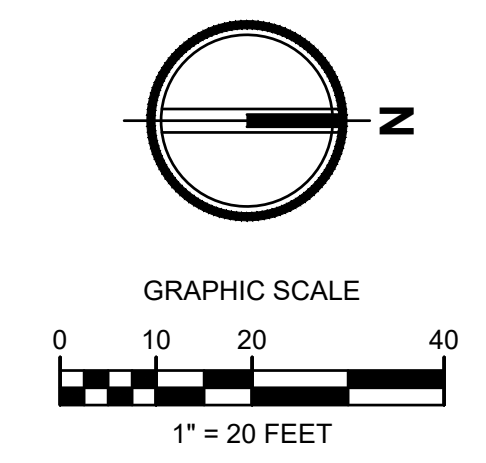

TACOMA • SEATTLE • SPOKANE • TRI-CITIES

2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE  
 A REVISION OF THIS DOCUMENT SHALL VALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PUBLICATION OF THE DOCUMENT DOES NOT CONSTITUTE A REVISED OR CORRECTED PROJECT. IT IS THE DUTY OF THE USER ONLY FOR THE PROJECT EXISTING IN THE TITLE BLOCK AND NOT TO BE USED FOR OTHER, RELATED, OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:



03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Sheet Title:  
**GRADING PLAN NE**

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C3.03**  
 13 of 53 Sheets

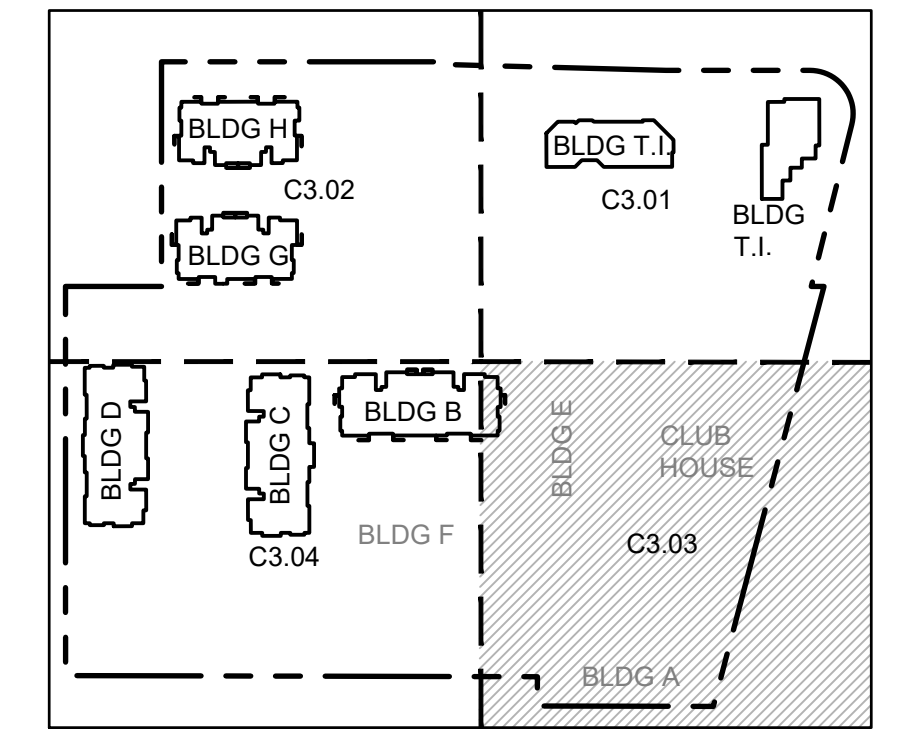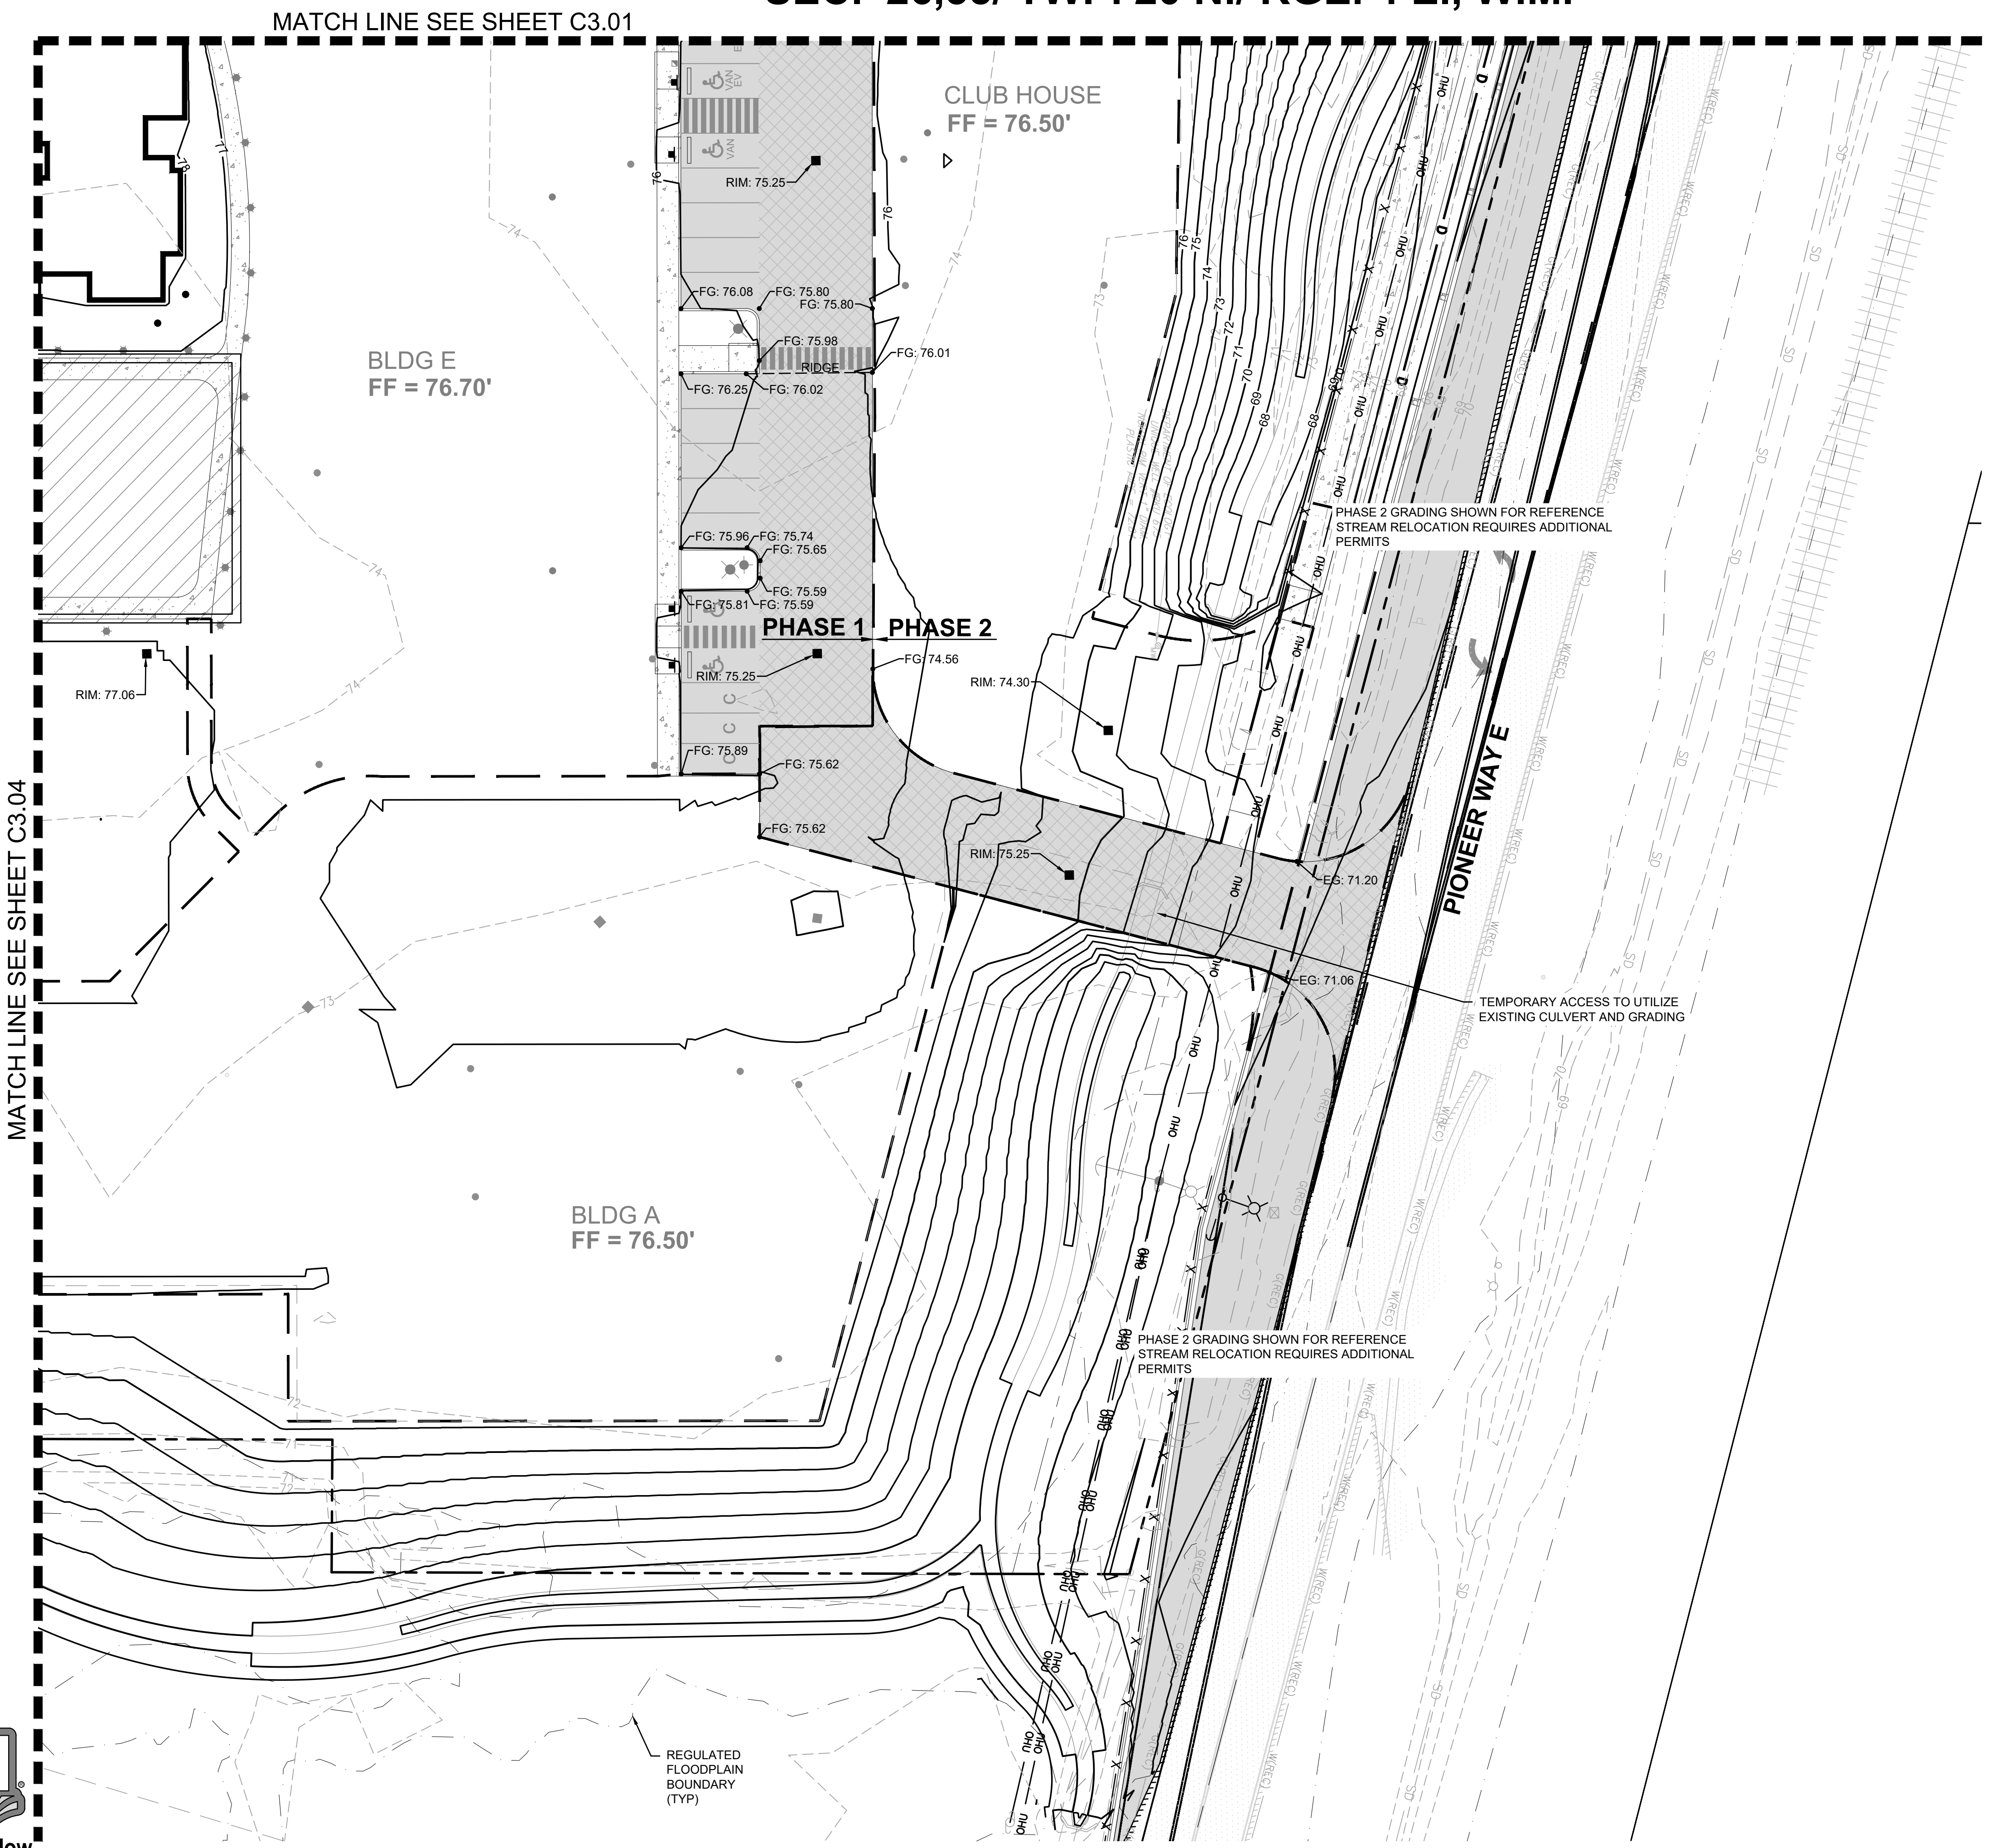

MATCH LINE SEE SHEET C3.04

MATCH LINE SEE SHEET C3.01






# EAST TOWN CROSSING PHASE 1


## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

MATCH LINE SEE SHEET C3.02

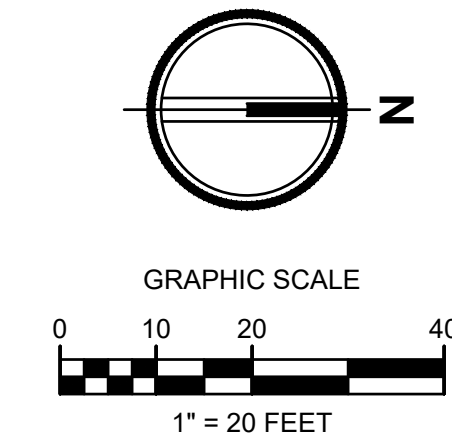

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

TACOMA • SEATTLE • SPOKANE • TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

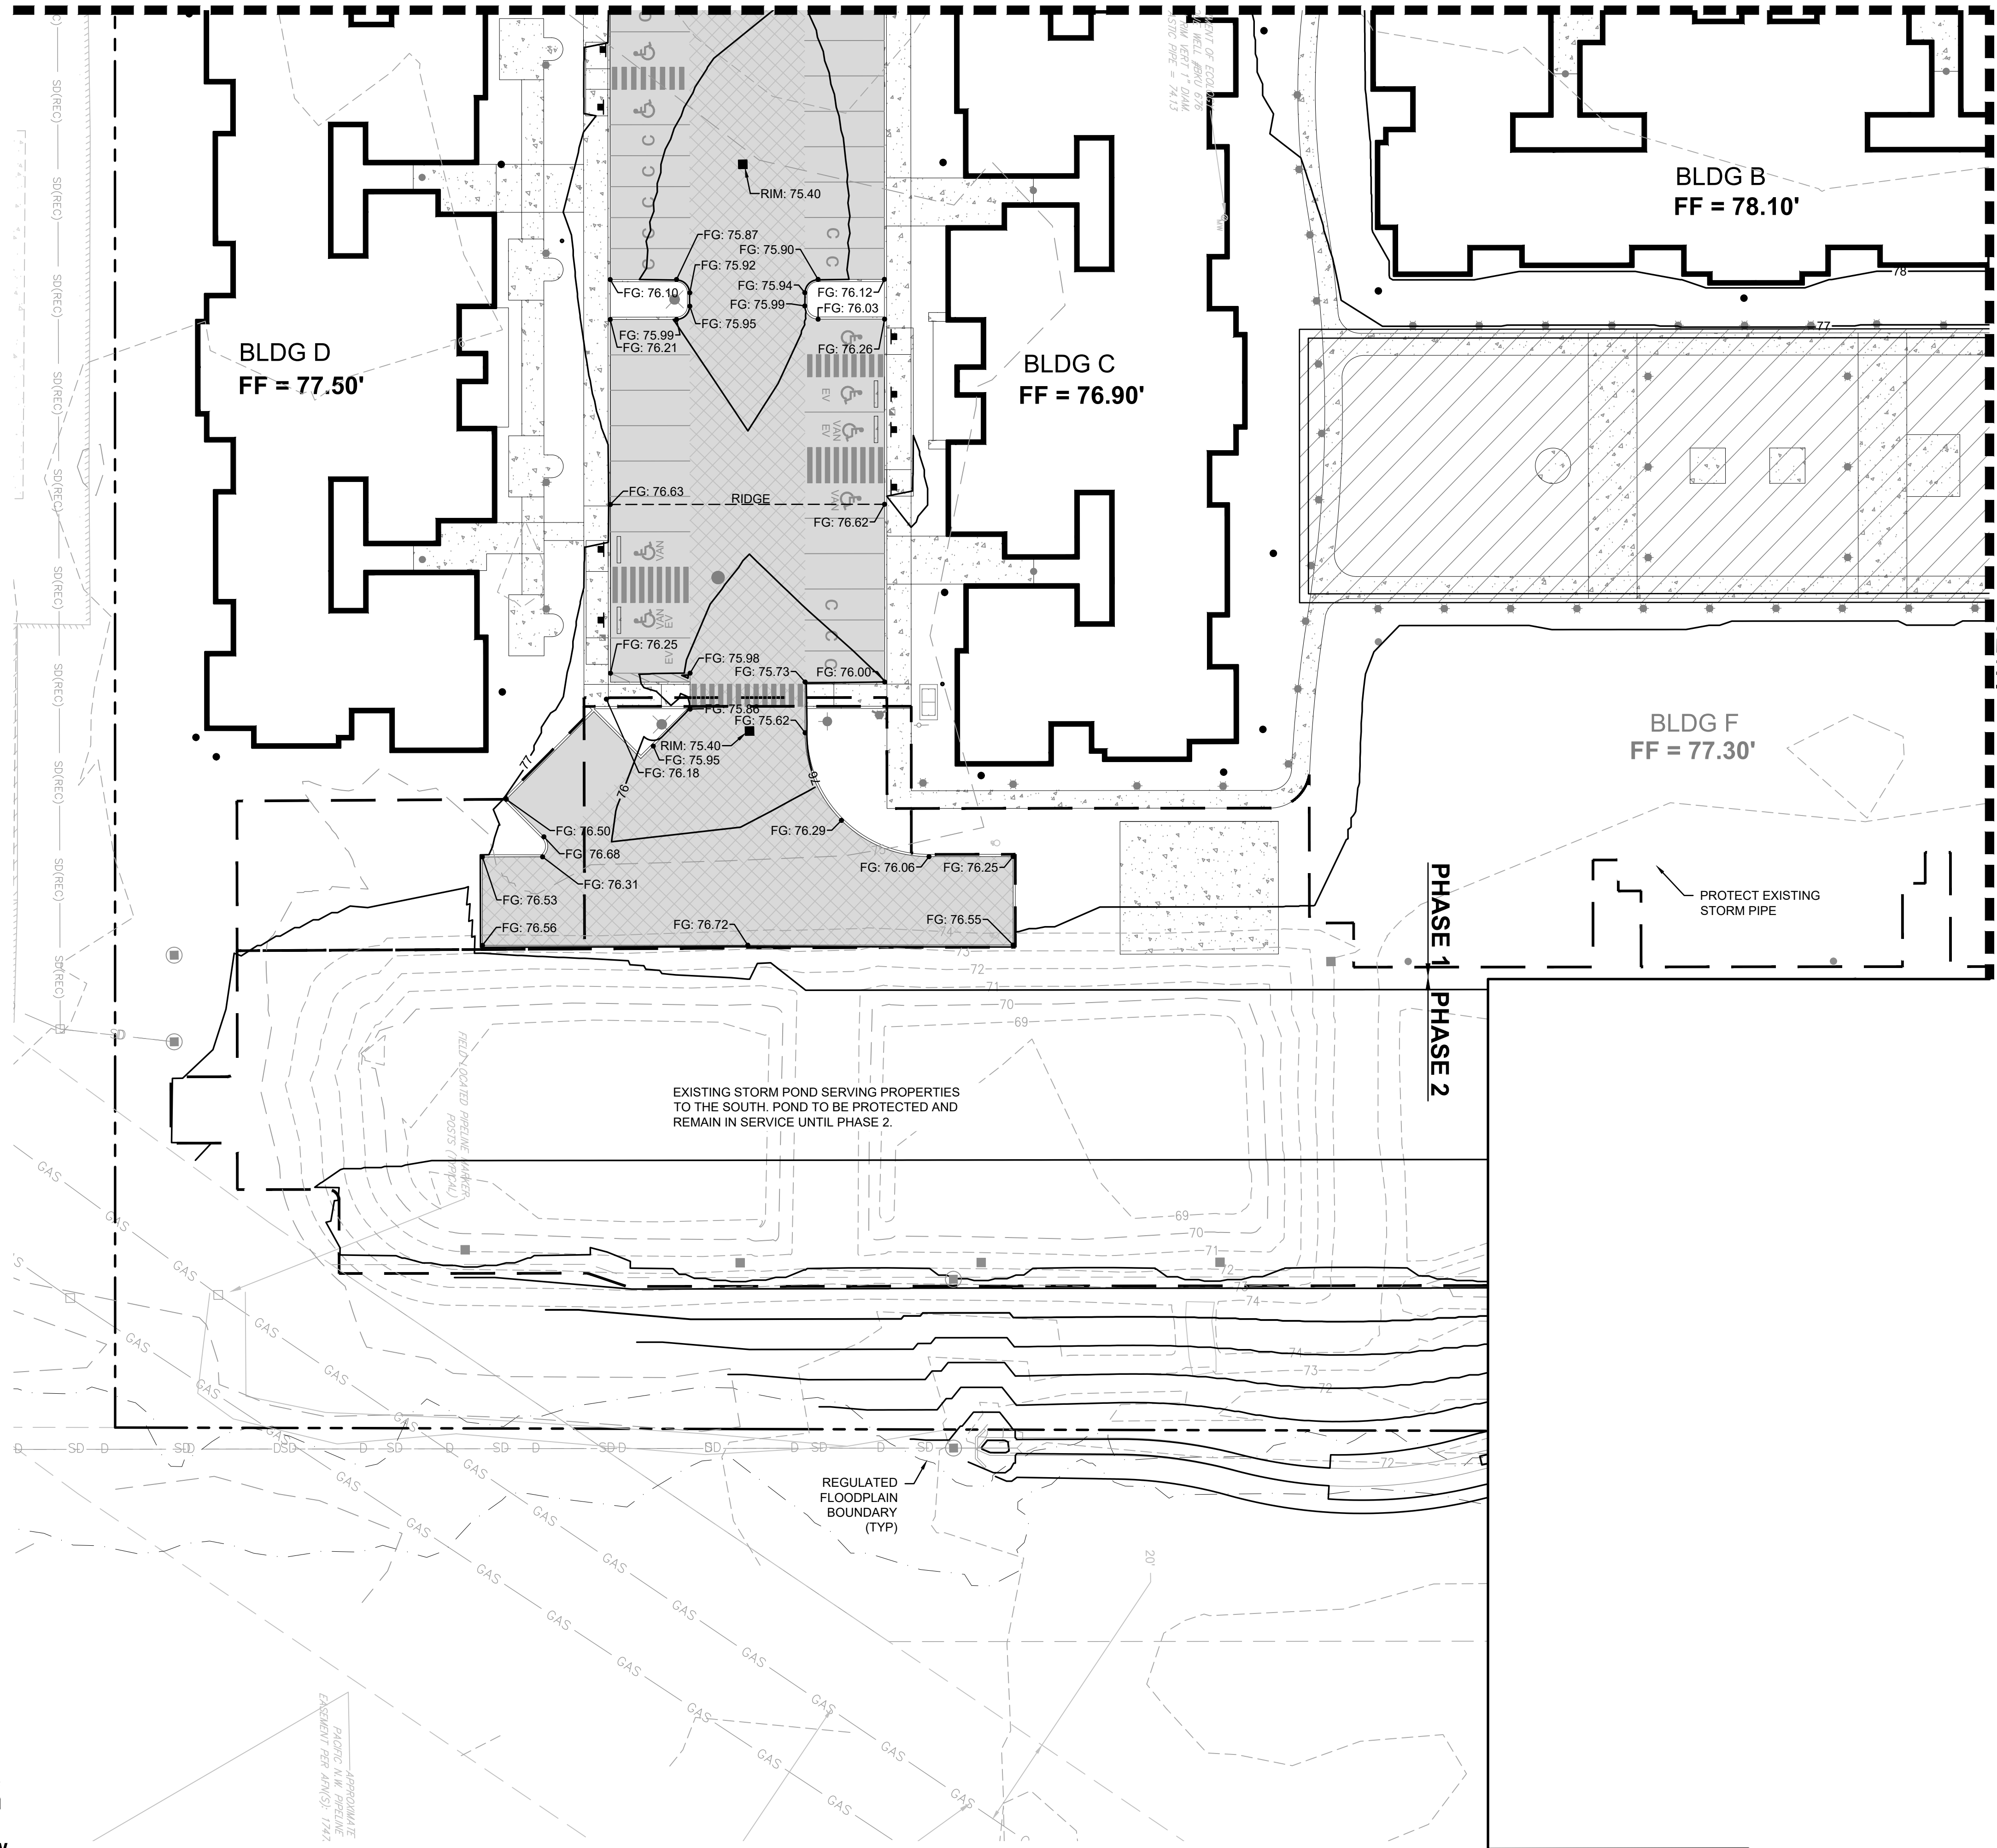

MATCH LINE SEE SHEET C3.03

PHASE 1 PHASE 2

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

Client Contact:  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
 PERMIT SUBMITTAL  
 05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A PROFESSIONAL ENGINEER'S LIABILITY INSURANCE POLICY. THIS DOCUMENT IS FOR THE PROJECT DESCRIBED IN THE TITLE BLOCK ONLY AND IS NOT TO BE USED FOR OTHER PROJECTS OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.


City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

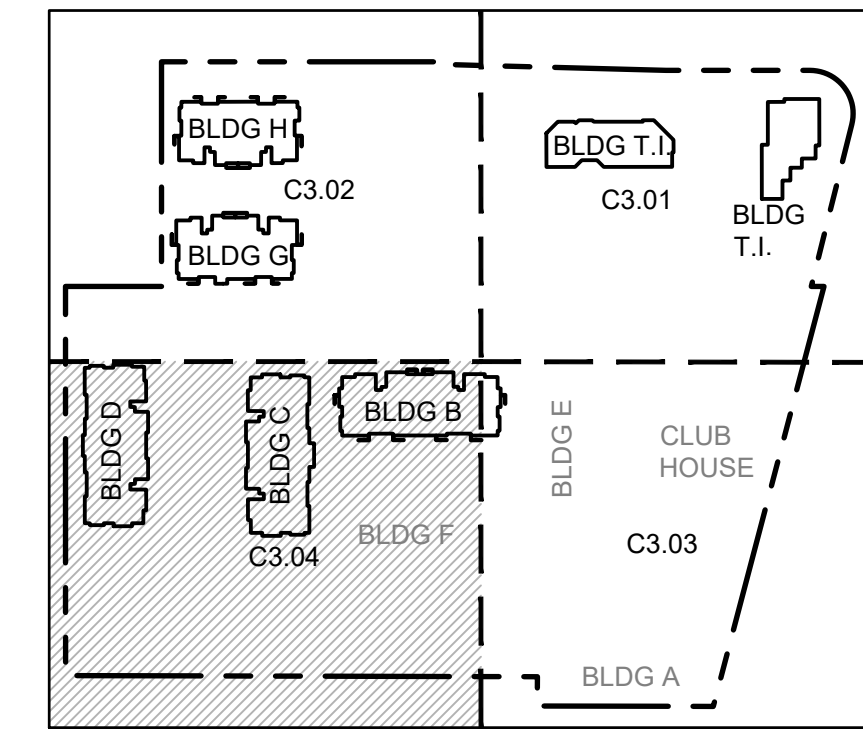

### GRADING PLAN SE

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C3.04**  
 14 of 53 Sheets





# EAST TOWN CROSSING PHASE 1



## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

**APPROVED**

BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING

DATE: 06/06/2024


NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

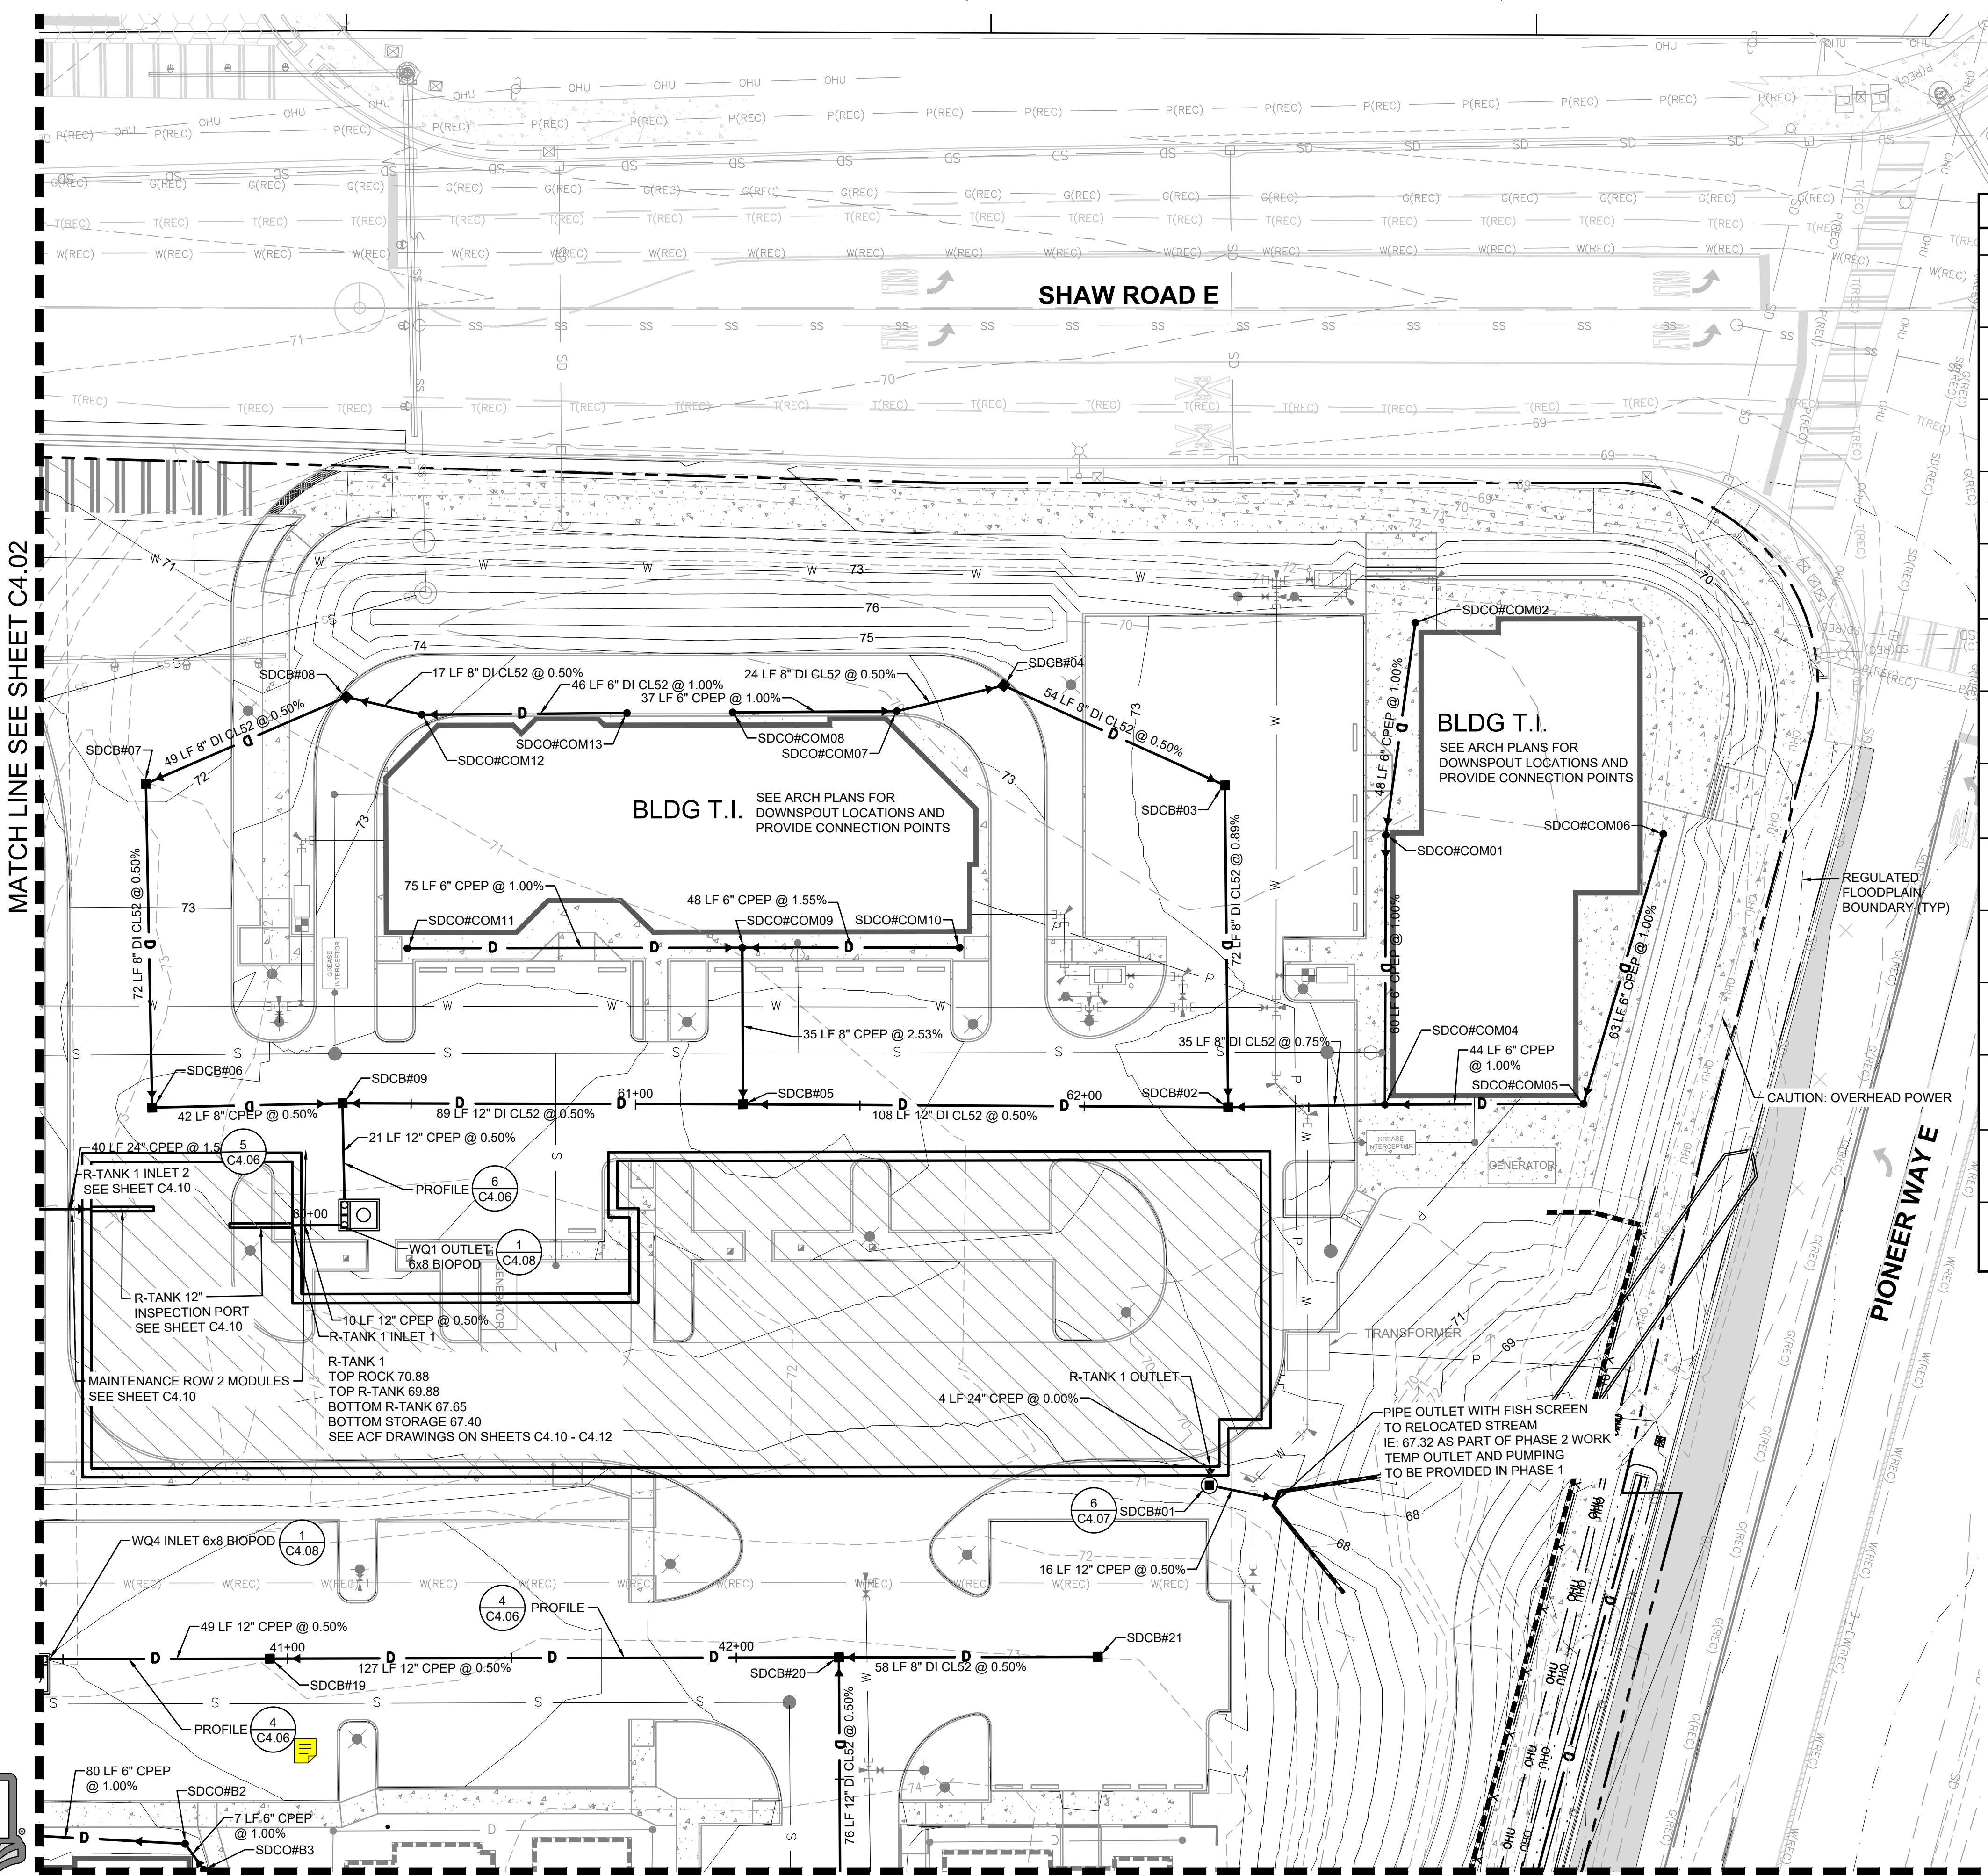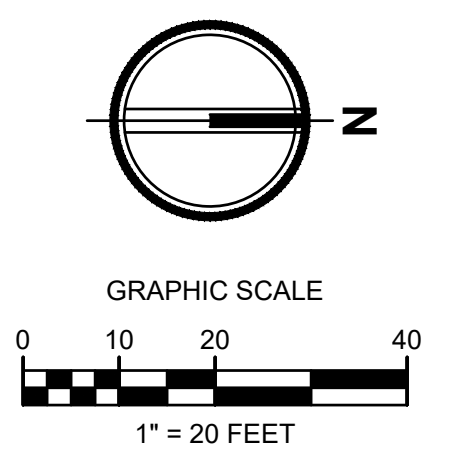

STORM STRUCTURE TABLE		STORM STRUCTURE TABLE	
STRUCTURE NAME	STRUCTURE DETAILS	STRUCTURE NAME	STRUCTURE DETAILS
R-TANK 1 INLET 1 N 679890.39 E 1203965.82	IE = 67.58 (12" N)	SDCB#21 TYPE 1 N 680067.90 E 1204065.38	RIM = 75.25 IE = 71.60 (8" S)
R-TANK 1 INLET 2 N 679845.57 E 1203961.30	IE = 67.79 (24" S)	SDCO#B2 N 679863.80 E 1204103.07	RIM = 77.58 IE = 75.07 (6" NE) IE = 75.07 (6" S)
R-TANK 1 OUTLET N 680093.81 E 1204023.48	IE = 67.40 (24" E)	SDCO#B3 N 679867.81 E 1204108.90	RIM = 77.26 IE = 75.14 (6" SW)
SDCB#01 54" CONTROL STRUCTURE N 680093.51 E 1204027.65	RIM = 75.51 IE = 67.40 (24" W) IE = 67.40 (12" N)	SDCO#COM01 N 680135.62 E 1203883.57	RIM = 73.56 IE = 70.74 (6" E) IE = 70.74 (6" W)
SDCB#02 TYPE 1 N 680099.34 E 1203943.53	RIM = 72.50 IE = 69.88 (8" W) IE = 69.88 (12" S)	SDCO#COM02 N 680143.12 E 1203836.41	RIM = 73.55 IE = 71.22 (6" E)
SDCB#03 TYPE 1 N 680100.00 E 1203871.83	RIM = 72.19 IE = 70.52 (8" W) IE = 70.52 (8" SW)	SDCO#COM04 N 680134.27 E 1203943.64	RIM = 73.55 IE = 70.14 (6" N) IE = 70.14 (6" W) IE = 70.14 (8" S)
SDCB#04 TYPE 1 N 680051.13 E 1203848.63	RIM = 72.72 IE = 70.79 (8" NE) IE = 70.79 (8" S)	SDCO#COM05 N 680178.50 E 1203944.30	RIM = 73.54 IE = 70.58 (6" W) IE = 70.58 (6" S)
SDCB#05 TYPE 1 N 679991.28 E 1203940.77	RIM = 72.50 IE = 69.29 (8" W) IE = 69.29 (12" N)	SDCO#COM06 N 680197.46 E 1203884.56	RIM = 73.56 IE = 71.21 (6" E)
SDCB#06 TYPE 1 N 679859.67 E 1203938.96	RIM = 72.68 IE = 69.06 (8" W) IE = 69.06 (8" N)	SDCO#COM07 N 680027.25 E 1203853.88	RIM = 73.15 IE = 70.91 (8" N) IE = 71.08 (6" S)
SDCB#07 TYPE 1 N 679859.67 E 1203866.80	RIM = 71.79 IE = 69.42 (8" E) IE = 69.42 (8" N)	SDCO#COM08 N 679990.68 E 1203853.44	RIM = 73.68 IE = 71.45 (6" N)
SDCB#08 TYPE 1 N 679904.68 E 1203848.32	RIM = 72.48 IE = 69.67 (8" N) IE = 69.67 (8" S)	SDCO#COM09 N 679991.81 E 1203905.90	RIM = 73.64 IE = 70.34 (8" E) IE = 70.34 (6" N)
SDCB#09 TYPE 1 N 679902.08 E 1203938.02	RIM = 72.28 IE = 68.84 (8" S) IE = 68.51 (12" N) IE = 68.51 (12" E)	SDCO#COM10 N 680040.22 E 1203906.79	RIM = 73.64 IE = 71.09 (6" S)
SDCB#19 TYPE 1 N 679883.48 E 1204062.20	RIM = 75.25 IE = 70.35 (12" S) IE = 70.35 (12" N)	SDCO#COM11 N 679917.20 E 1203904.57	RIM = 73.61 IE = 71.09 (6" N)
SDCB#20 TYPE 1 N 680010.25 E 1204064.38	RIM = 75.25 IE = 70.98 (12" S) IE = 71.31 (8" N) IE = 70.98 (12" E)	SDCO#COM12 N 679921.42 E 1203852.60	RIM = 72.88 IE = 69.93 (6" N) IE = 69.76 (8" S)

### DETAIL REFERENCES

- CATCH BASIN TYPE 1 (AREA DRAIN)
- CATCH BASIN TYPE 1 (GUTTER DRAIN)
- FOR CATCH BASIN TYPE II
- FRENCH DRAIN
- STORM SEWER MANHOLE

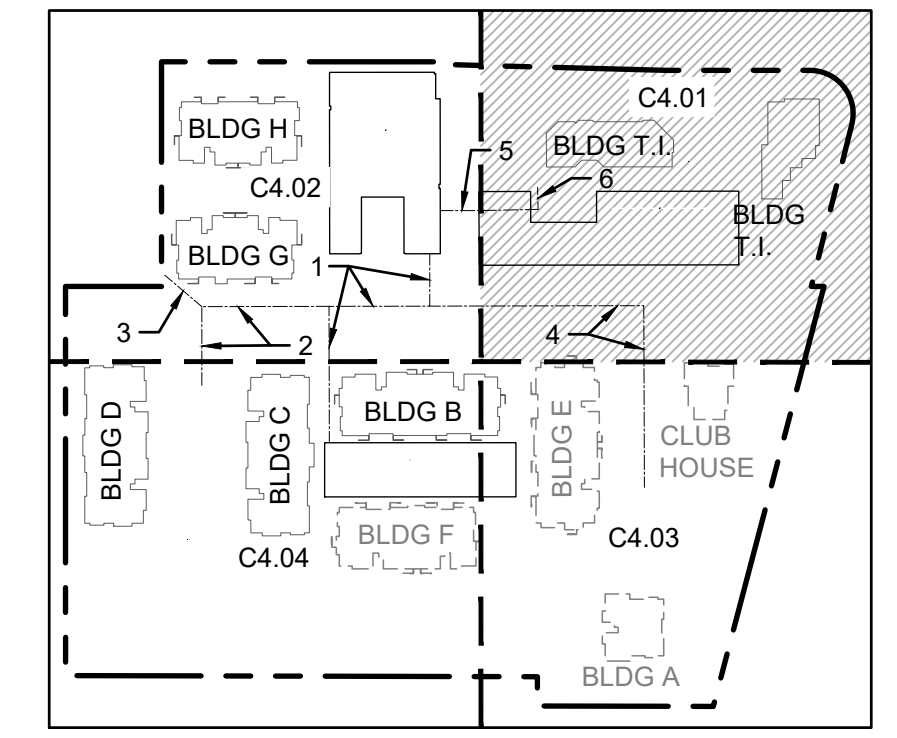

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
**ASH DEVELOPMENT**

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE: ALTERNATION OF THIS DOCUMENT SHALL MAINTAIN THE PROFESSIONAL SEAL AND SIGNATURE PREPARATION OF THIS DOCUMENT DOES NOT CONSTITUTE A REVIEW OF THE PROJECT EXCEPT IN THE TITLE BLOCK AND IT IS NOT TO BE USED FOR OTHER PROJECTS OR ADDITION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

**City of Puyallup Development & Permitting Services ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:

- 03/29/24 CITY COMMENTS
- 01/29/24 CITY COMMENTS

Sheet Title:  
**STORM DRAINAGE PLAN NW**

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI

Sheet No.  
**C4.01**  
 15 of 53 Sheets




MATCH LINE SEE SHEET C4.02

MATCH LINE SEE SHEET C4.03



# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

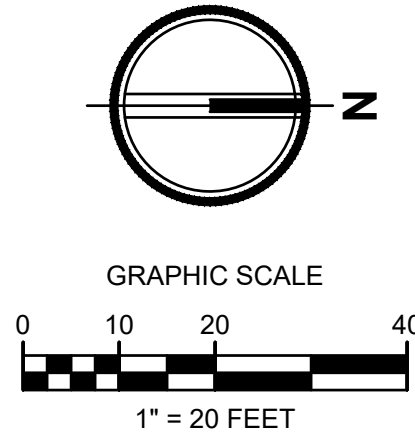

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.



Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

Project No.  
 2230752

Issue Set & Date:  
 PERMIT SUBMITTAL  
 05/17/2024




NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE AN ENDORSEMENT OR GUARANTEE BY THE ENGINEER. THE ENGINEER IS NOT TO BE USED FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**


Building	Planning
Engineering	Public Works
Fire	Traffic

### DETAIL REFERENCES

CATCH BASIN TYPE 1 (AREA DRAIN)	1 C4.07
CATCH BASIN TYPE 1 (GUTTER DRAIN)	2 C4.07
FOR CATCH BASIN TYPE II	3 C4.07
FRENCH DRAIN	5 C4.07
STORM SEWER MANHOLE	8 C4.07

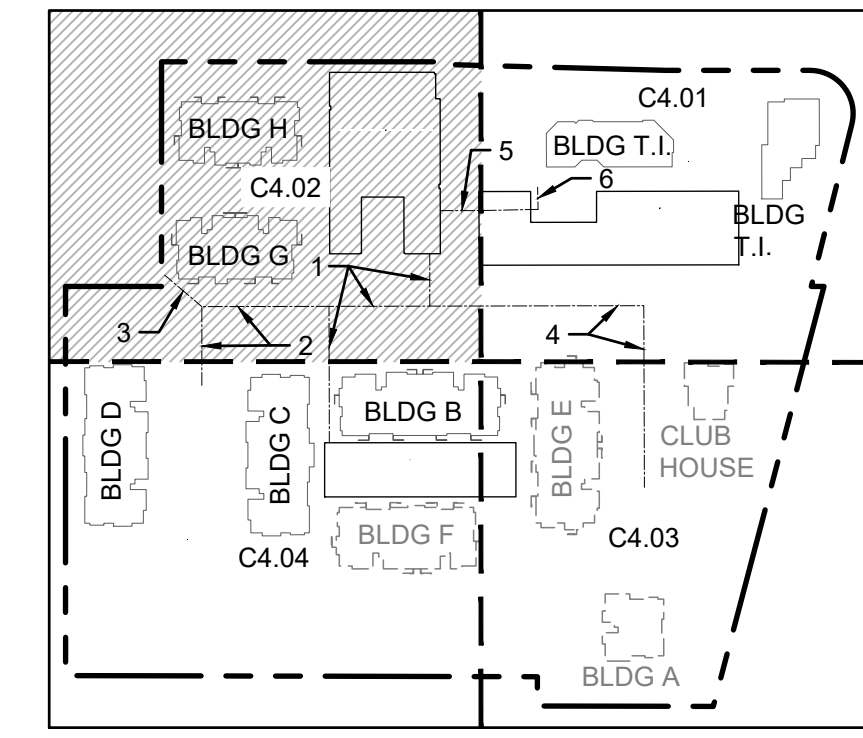

STORM STRUCTURE TABLE		STORM STRUCTURE TABLE	
STRUCTURE NAME	STRUCTURE DETAILS	STRUCTURE NAME	STRUCTURE DETAILS
AREA DRAIN G1 TYPE 1 N 679651.27 E 1203988.13	RIM = 77.13 IE = 73.07 (6° NE)	SDCB#17 TYPE 1 N 679662.59 E 1203988.62	RIM = 76.64 IE = 72.75 (8° W) IE = 72.92 (6° SE) IE = 72.92 (6° SW)
AREA DRAIN G2 TYPE 1 N 679648.92 E 1203945.32	RIM = 77.43 IE = 72.78 (6° S) IE = 72.78 (8° NE)	SDCB#18 48" TYPE 2 SOLID LOCKING LID N 679787.40 E 1204060.54	RIM = 76.69 IE = 69.40 (12° N) IE = 69.73 (8° E) IE = 68.40 (24° S) IE = 68.40 (24° W)
AREA DRAIN H1 TYPE 1 N 679654.11 E 1203854.54	RIM = 77.10 IE = 72.33 (6° N)	SDCB#26 48" TYPE 2 SOLID LOCKING LID N 679682.46 E 1204058.73	RIM = 76.79 IE = 69.40 (12° S) IE = 68.40 (24° E) IE = 68.40 (24° N)
AREA DRAIN H2 TYPE 1 N 679651.43 E 1203896.03	RIM = 77.04 IE = 72.58 (6° S) IE = 72.58 (8° N)	SDCB#27 TYPE 1 N 679550.01 E 1204056.45	RIM = 75.52 IE = 71.54 (8° S) IE = 71.20 (12° N) IE = 71.20 (12° SW) IE = 71.20 (12° E)
R-TANK 2 INLET 1 N 679799.41 E 1203935.82	IE = 68.87 (12° N)	SDCB#28 TYPE 1 N 679427.04 E 1204054.32	RIM = 75.25 IE = 72.15 (8° N) IE = 72.15 (8° E)
R-TANK 2 INLET 2 N 679687.01 E 1203851.93	IE = 68.87 (12° S)	SDCB#40 TYPE 1 N 679510.96 E 1204021.83	RIM = 76.45 IE = 72.24 (12° NE)
R-TANK 2 INLET 3 N 679787.89 E 1204034.66	IE = 68.40 (24° E)	SDCO#B1 N 679783.96 E 1204097.21	RIM = 77.21 IE = 74.27 (6° S) IE = 74.10 (8° W)
R-TANK 2 OUTLET N 679800.24 E 1203960.54	IE = 68.40 (24° N)	SDCO#B4 N 679691.87 E 1204095.49	RIM = 77.67 IE = 75.19 (6° N)
SDCB#10 54" CONTROL STRUCTURE N 679805.24 E 1203960.64	RIM = 77.20 IE = 68.40 (24° S) IE = 68.40 (24° N)	SDCO#C2 N 679593.93 E 1204102.08	RIM = 76.86 IE = 73.50 (6° NW) IE = 73.50 (6° E)
SDCB#11 TYPE 1 N 679815.72 E 1203936.19	RIM = 76.68 IE = 71.81 (8° W) IE = 71.81 (8° E) IE = 71.49 (12° S)	SDCO#C3 N 679599.10 E 1204098.64	RIM = 76.93 IE = 73.57 (6° SE)
SDCB#12 TYPE 1 N 679814.62 E 1204000.39	RIM = 76.60 IE = 72.45 (8° W)	SDCO#C7 N 679659.20 E 1204103.40	RIM = 77.06 IE = 72.72 (6° NE)
SDCB#13 TYPE 1 N 679817.31 E 1203857.02	RIM = 76.62 IE = 72.60 (8° E)	SDCO#D5 N 679494.55 E 1204097.47	RIM = 77.41 IE = 73.83 (6° SW) IE = 73.83 (6° E)
SDCB#14 TYPE 1 N 679664.01 E 1203894.81	RIM = 76.84 IE = 71.89 (12° W) IE = 72.22 (8° S) IE = 71.89 (12° E)	SDCO#D6 N 679489.70 E 1204094.51	RIM = 77.38 IE = 73.89 (6° NE)
SDCB#15 TYPE 1 N 679668.39 E 1203851.68	RIM = 76.30 IE = 71.68 (12° E) IE = 72.18 (6° SW) IE = 71.68 (12° N) IE = 72.18 (6° S)	SDCO#G2 N 679528.62 E 1203943.63	RIM = 76.83 IE = 73.98 (6° N)
SDCB#16 TYPE 1 N 679662.74 E 1203962.56	RIM = 76.89 IE = 72.57 (8° E) IE = 72.23 (12° W) IE = 72.56 (8° SW)	SDCO#G3 N 679648.60 E 1204018.45	RIM = 77.18 IE = 73.16 (6° S) IE = 73.16 (6° NW)

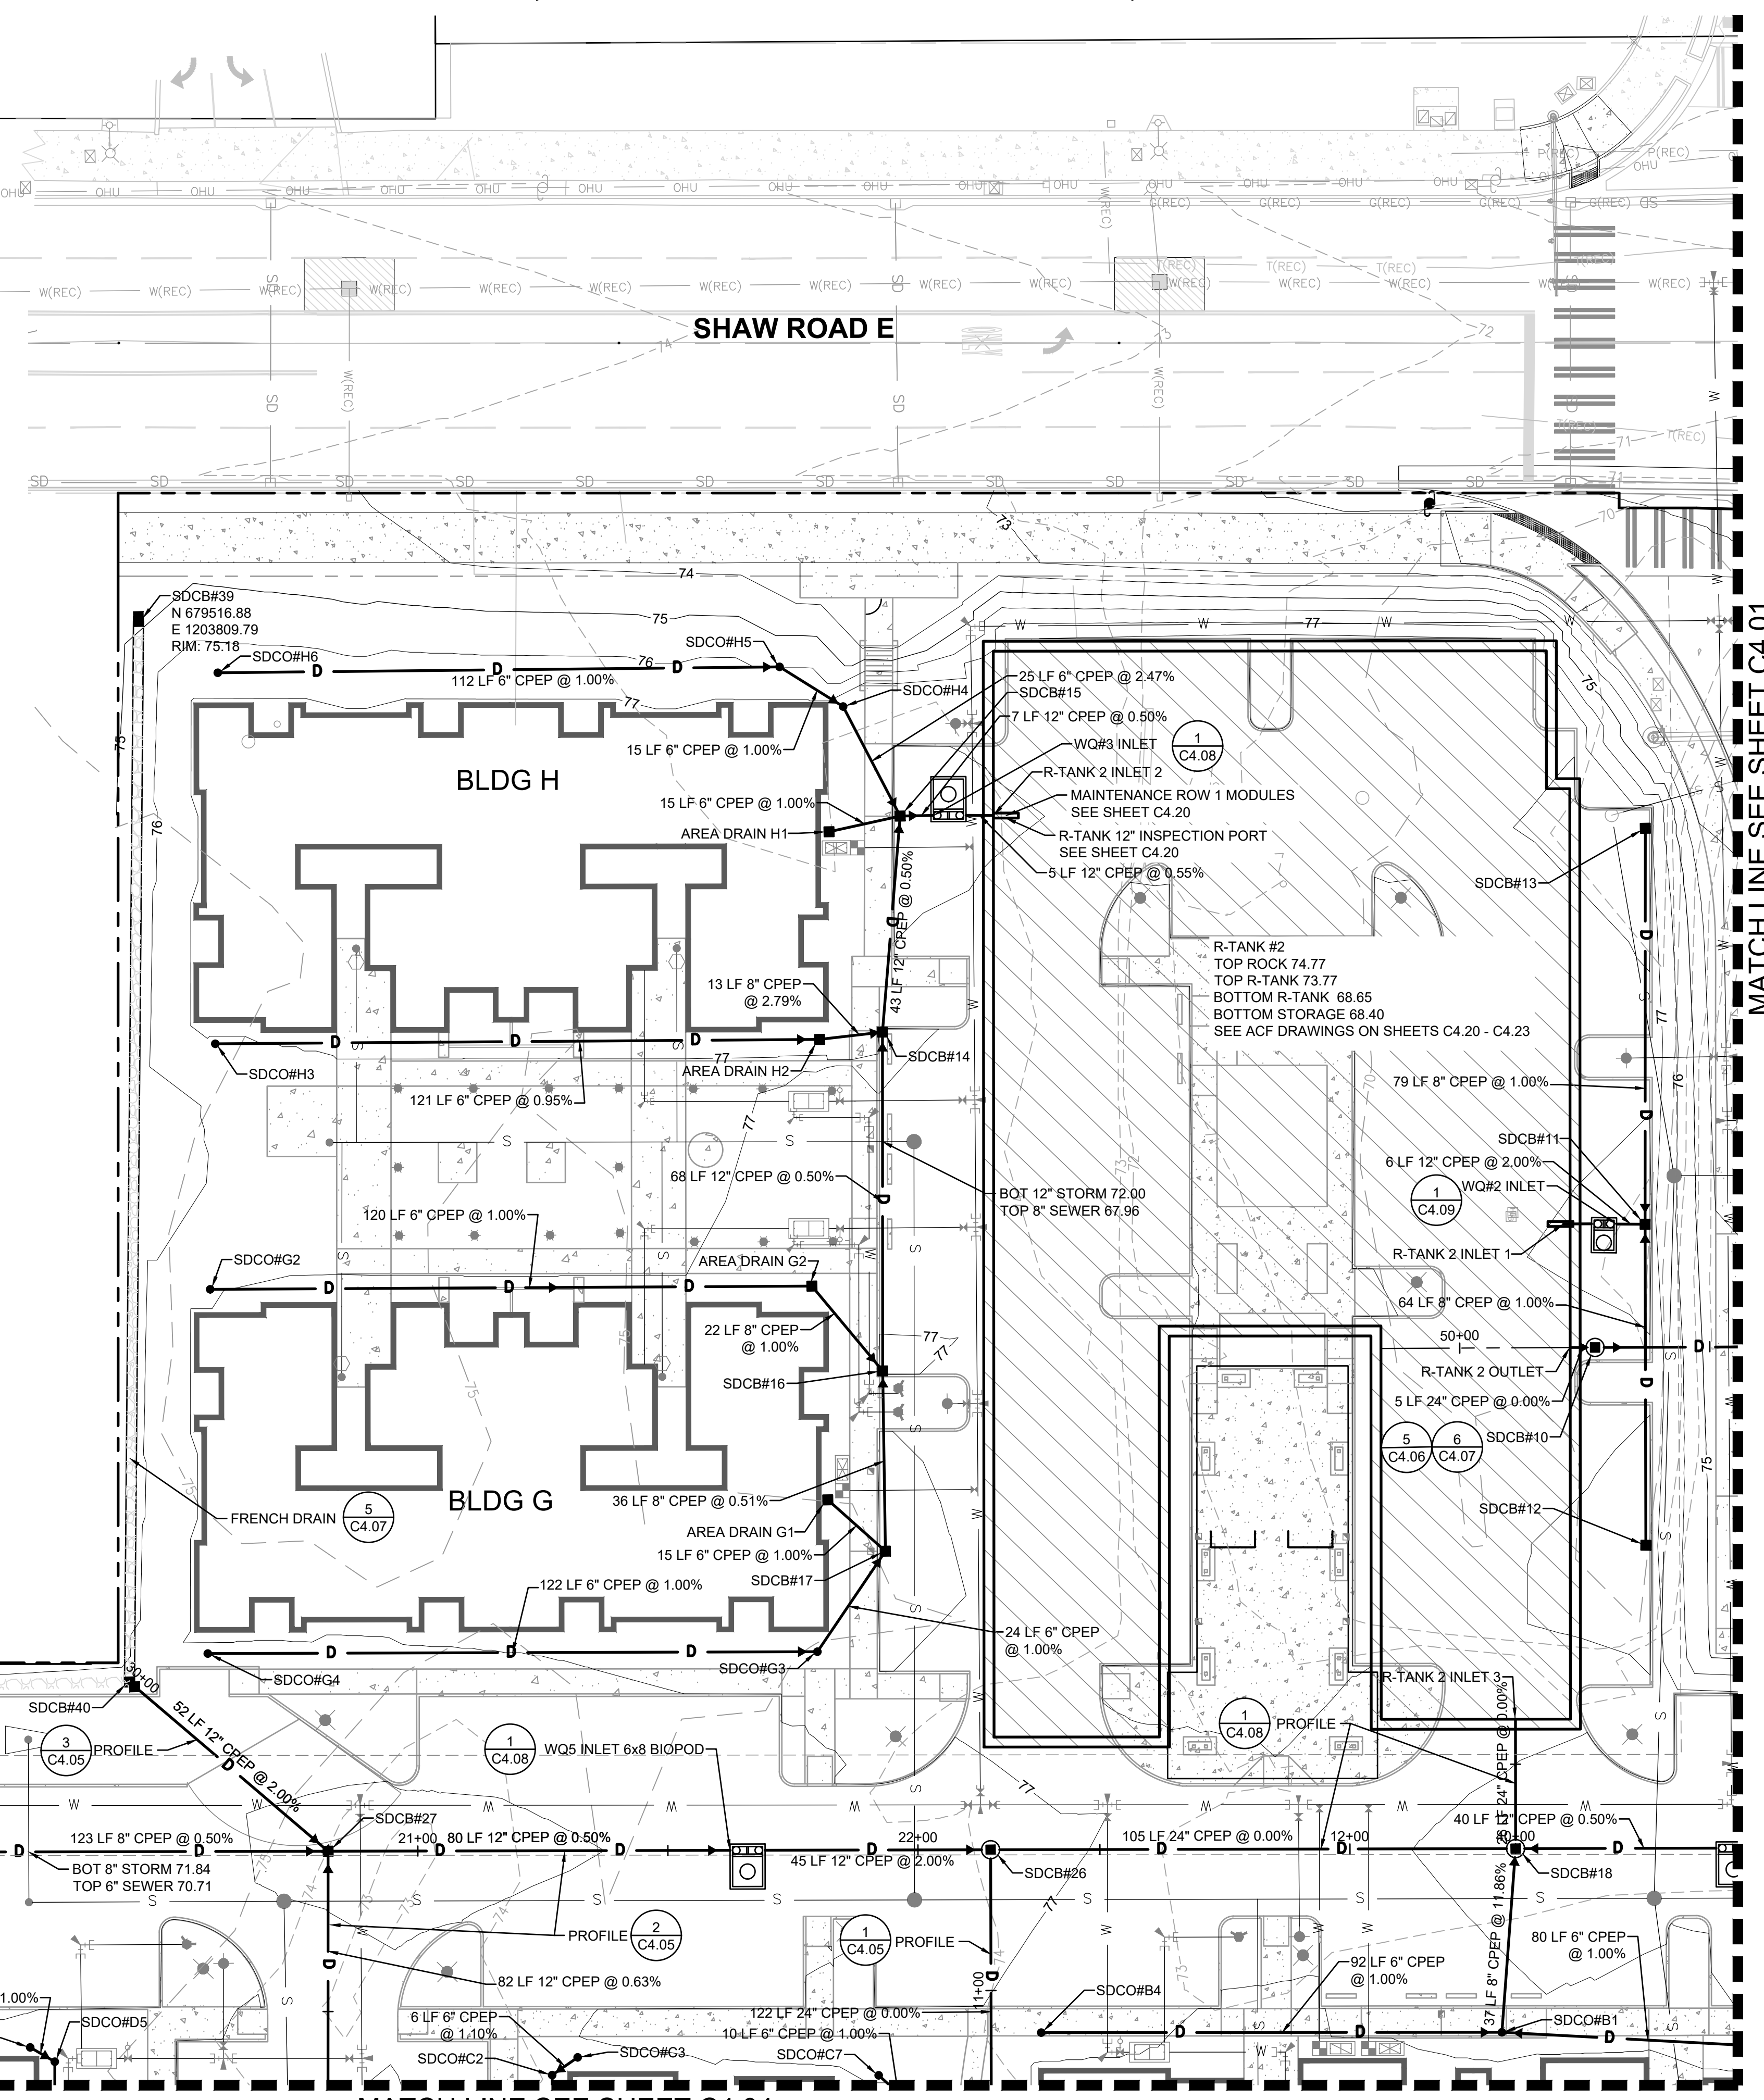

MATCH LINE SEE SHEET C4.01

MATCH LINE SEE SHEET C4.04



Revisions:

Sheet Title:  
**STORM DRAINAGE PLAN SW**

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI

Sheet No.  
**C4.02**  
 16 of 53 Sheets




# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

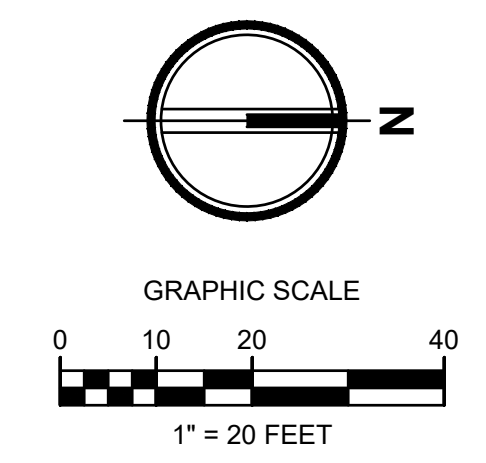

TACOMA • SEATTLE • SPOKANE • TRI-CITIES

2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 04/09/2024



NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OR WARRANTY BY THE ENGINEER OR THE CITY OF PUYALLUP. THE ENGINEER OR THE CITY OF PUYALLUP SHALL NOT BE HELD RESPONSIBLE FOR ANY ERRORS OR OMISSIONS IN THIS DOCUMENT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**


Building	Planning
Engineering	Public Works
Fire	Traffic

STORM STRUCTURE TABLE	
STRUCTURE NAME	STRUCTURE DETAILS
R-TANK 3 INLET 2 N 679853.13 E 1204241.42	IE = 68.40 (12" E)
SDCB#22 TYPE 1 N 680009.17 E 1204140.15	RIM = 75.25 IE = 71.36 (12" E) IE = 71.36 (12" W) IE = 71.69 (8" N) IE = 71.69 (8" S)
SDCB#23 TYPE 1 N 680007.27 E 1204253.48	RIM = 75.25 IE = 71.93 (12" W) IE = 71.93 (8" N) IE = 72.26 (8" E) IE = 72.26 (8" S)
SDCB#24 TYPE 1 W/ SOLID LOCKING LID N 680073.82 E 1204272.43	RIM = 74.30 IE = 72.28 (8" E) IE = 72.28 (8" S)
SDCB#25 TYPE 1 N 680064.22 E 1204305.52	RIM = 75.25 IE = 72.79 (8" W)
SDCB#31 TYPE 2 N 679853.17 E 1204250.53	RIM = 77.06 IE = 68.52 (12" W) IE = 68.52 (12" NE) IE = 69.02 (6" S)
SDCO#B6 N 679857.14 E 1204174.57	RIM = 77.61 IE = 72.88 (6" S) IE = 72.88 (6" NW)
SDCO#B7 N 679863.70 E 1204168.09	RIM = 77.70 IE = 72.97 (6" SE)

NOTE: CB#25 AND CONNECTING PIPE WILL BE REMOVED IN PHASE 2 FOR THE STREAM RELOCATION.

### DETAIL REFERENCES

- CATCH BASIN TYPE I (AREA DRAIN)
- CATCH BASIN TYPE I (GUTTER DRAIN)
- FOR CATCH BASIN TYPE II
- FRENCH DRAIN
- STORM SEWER MANHOLE

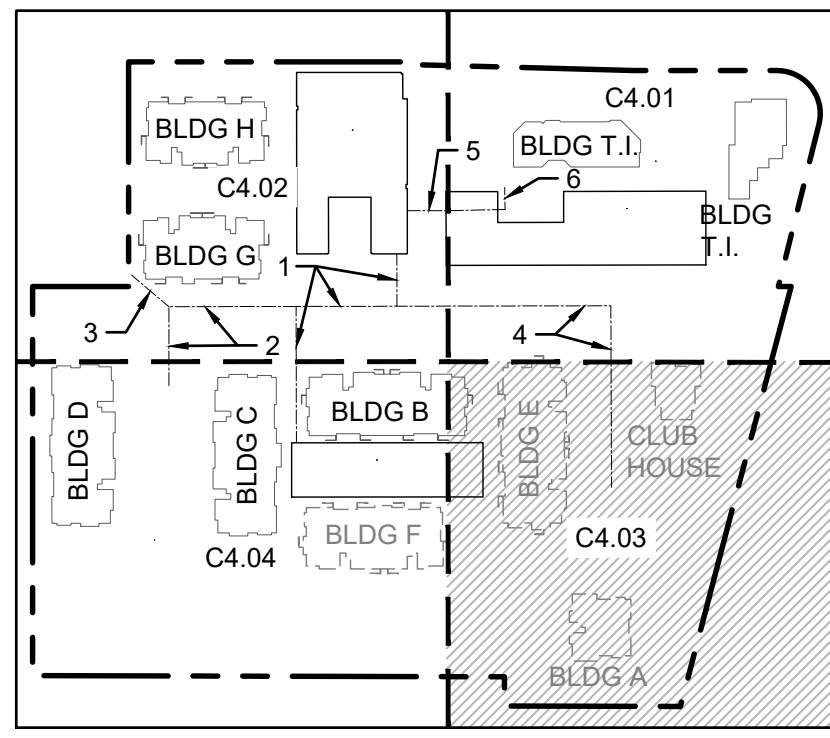


Revisions:

Sheet Title:  
**STORM DRAINAGE PLAN NE**

Designed by: CW    Drawn by: SK / RS    Checked by: JI

Sheet No.  
**C4.03**  
 17 of 53 Sheets

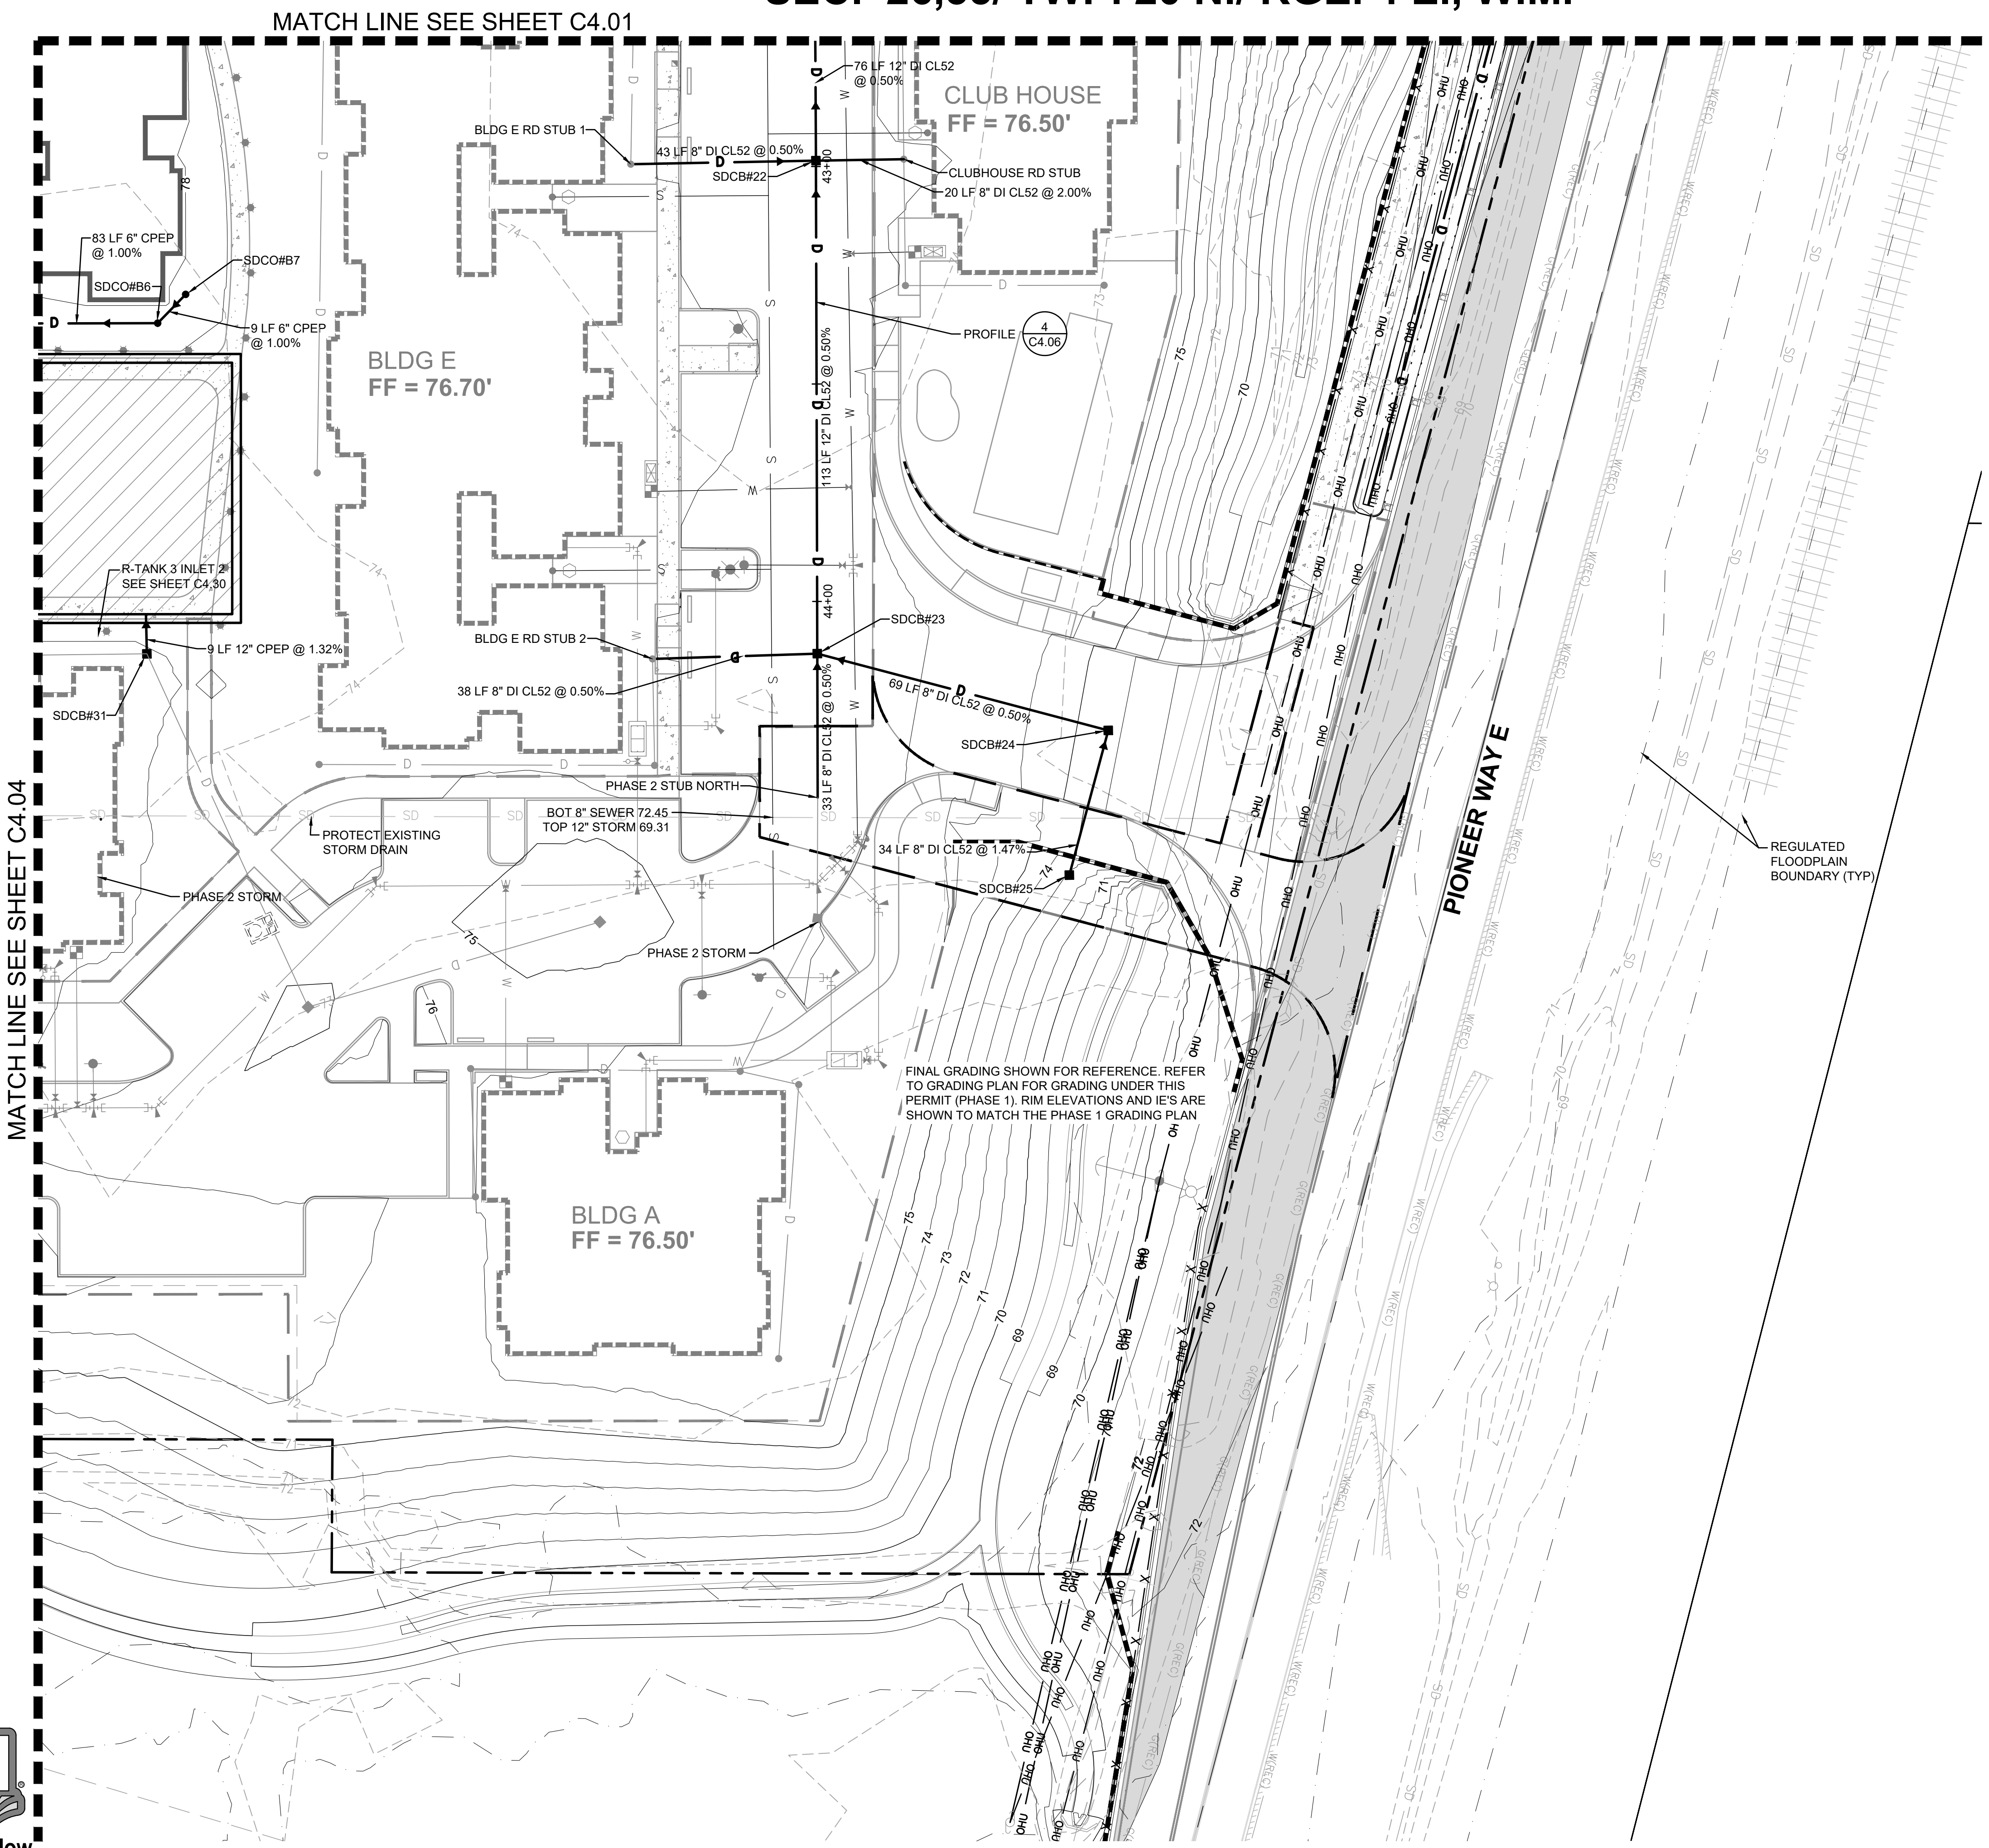

FINAL GRADING SHOWN FOR REFERENCE. REFER TO GRADING PLAN FOR GRADING UNDER THIS PERMIT (PHASE 1). RIM ELEVATIONS AND IE'S ARE SHOWN TO MATCH THE PHASE 1 GRADING PLAN






# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

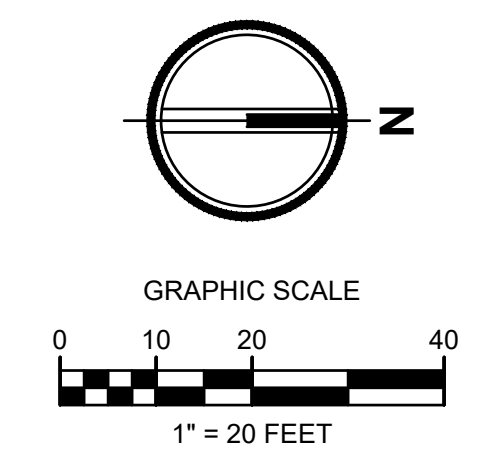

**AHBL**  
 TACOMA · SEATTLE · SPOKANE · TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE  
 ALIENATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PURSUANT TO THE STATUTES OF THE STATE OF WASHINGTON. THE ENGINEER OR ARCHITECT DOES NOT GUARANTEE, WARRANT, OR REPRESENT THAT THE INFORMATION CONTAINED HEREIN IS ACCURATE OR COMPLETE. THIS DOCUMENT IS NOT TO BE USED FOR ANY OTHER PROJECT OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:  
 03/29/24 CITY COMMENTS  
 01/29/24 CITY COMMENTS

Sheet Title:  
**STORM DRAINAGE PLAN SE**



Designed by: CW    Drawn by: SK/RS    Checked by: JI

Sheet No.  
**C4.04**  
 18 of 53 Sheets

STORM STRUCTURE TABLE		STORM STRUCTURE TABLE	
STRUCTURE NAME	STRUCTURE DETAILS	STRUCTURE NAME	STRUCTURE DETAILS
R-TANK 3 INLET 1 N 679774.01 E 1204182.12	IE = 71.94 (6" W)	SDCO#C9 N 679654.41 E 1204278.00	RIM = 76.85 IE = 72.37 (6" NW) IE = 72.37 (6" S)
R-TANK 3 INLET 3 N 679679.58 E 1204238.19	RIM = 70.56 IE = 68.40 (24" E)	SDCO#C10 N 679599.58 E 1204277.70	RIM = 76.81 IE = 72.92 (6" N)
R-TANK 3 INLET 4 N 679674.54 E 1204228.76	RIM = 72.15 IE = 71.40 (8" S)	SDCO#D1 N 679423.88 E 1204102.02	RIM = 77.28 IE = 73.01 (6" E) IE = 72.84 (8" W)
R-TANK 3 OUTLET N 679680.40 E 1204180.36	RIM = 70.56 IE = 68.40 (24" W)	SDCO#D2 N 679422.23 E 1204265.61	RIM = 77.33 IE = 74.65 (6" NE) IE = 74.65 (6" W)
SDCB#29 TYPE 1 N 679548.37 E 1204138.49	RIM = 75.40 IE = 72.05 (8" E) IE = 72.05 (8" S) IE = 72.05 (8" N) IE = 71.72 (12" W)	SDCO#D3 N 679426.74 E 1204270.10	RIM = 77.20 IE = 74.71 (6" SW)
SDCB#30 TYPE 1 N 679547.41 E 1204266.63	RIM = 75.40 IE = 72.69 (8" W)	SDCO#D4 N 679493.77 E 1204137.44	RIM = 77.45 IE = 73.43 (6" E) IE = 73.43 (6" W)
SDCO#B5 N 679774.12 E 1204173.14	RIM = 77.74 IE = 72.05 (6" S) IE = 72.05 (6" N) IE = 72.05 (6" E)	SDCO#D7 N 679491.69 E 1204256.70	RIM = 77.45 IE = 74.62 (6" W)
SDCO#B8 N 679691.50 E 1204169.91	RIM = 77.62 IE = 72.88 (6" N)		
SDCO#C1 N 679593.67 E 1204138.96	RIM = 76.84 IE = 73.21 (6" W) IE = 73.21 (6" E) IE = 73.04 (8" S)		
SDCO#C4 N 679592.12 E 1204236.14	RIM = 76.87 IE = 74.29 (6" W)		
SDCO#C5 N 679666.61 E 1204228.76	RIM = 76.86 IE = 71.44 (6" E) IE = 71.44 (6" W) IE = 71.44 (8" N)		
SDCO#C6 N 679666.79 E 1204110.58	RIM = 77.07 IE = 72.62 (6" E) IE = 72.62 (6" SW)		
SDCO#C8 N 679663.47 E 1204268.51	RIM = 76.87 IE = 72.24 (6" W) IE = 72.24 (6" SE)		

### DETAIL REFERENCES

- CATCH BASIN TYPE 1 (AREA DRAIN)
- CATCH BASIN TYPE 1 (GUTTER DRAIN)
- FOR CATCH BASIN TYPE II
- FRENCH DRAIN
- STORM SEWER MANHOLE

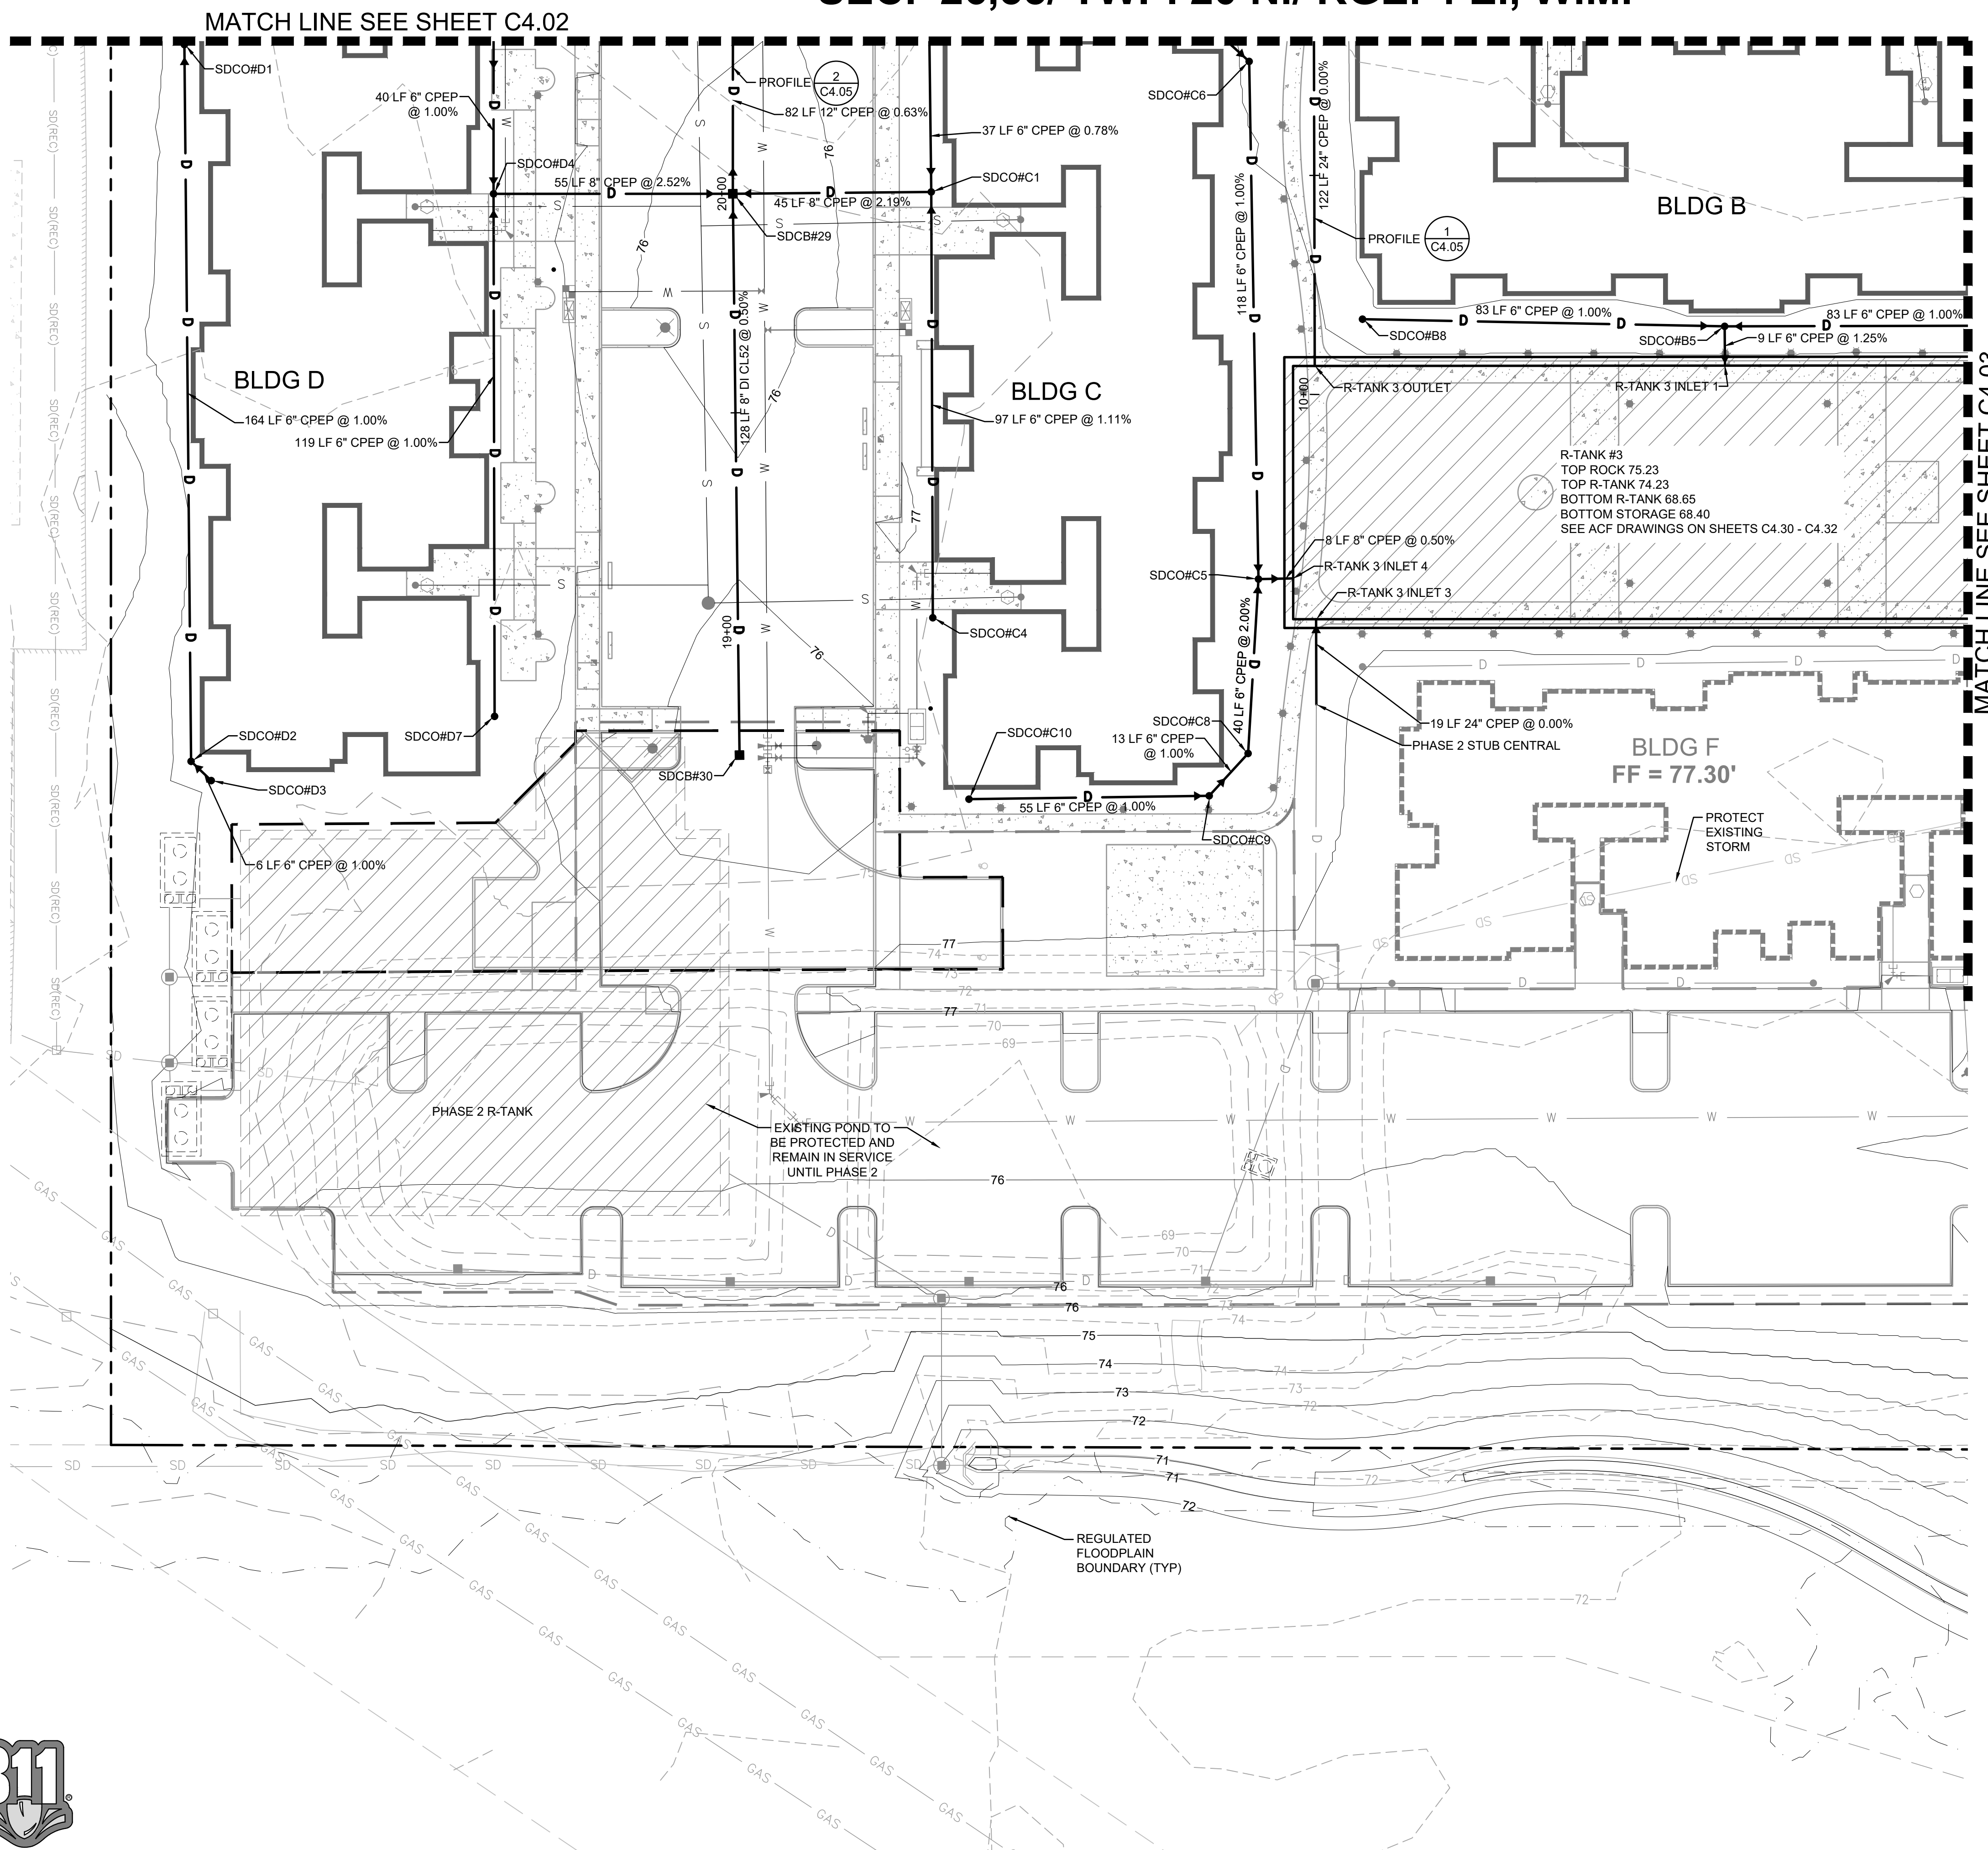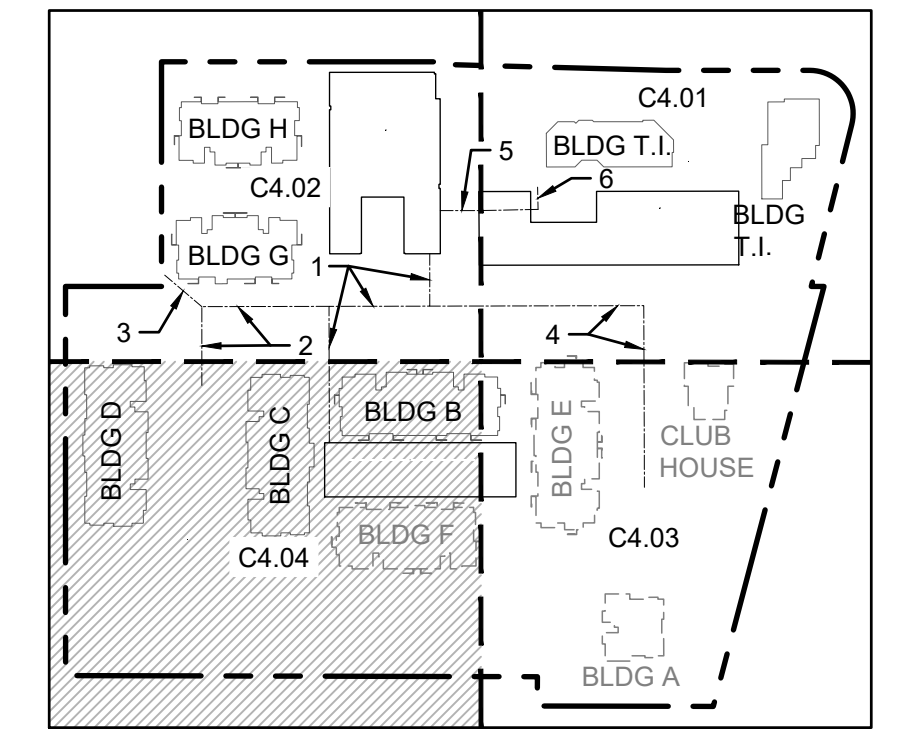



# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.



Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752


Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024




NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OR WARRANTY BY THE ENGINEER FOR THE PROJECT DESCRIBED IN THE TITLE BLOCK AND IS NOT TO BE USED FOR ANY OTHER PROJECT OR ADDITION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**


Building	Planning
Engineering	Public Works
Fire	Traffic

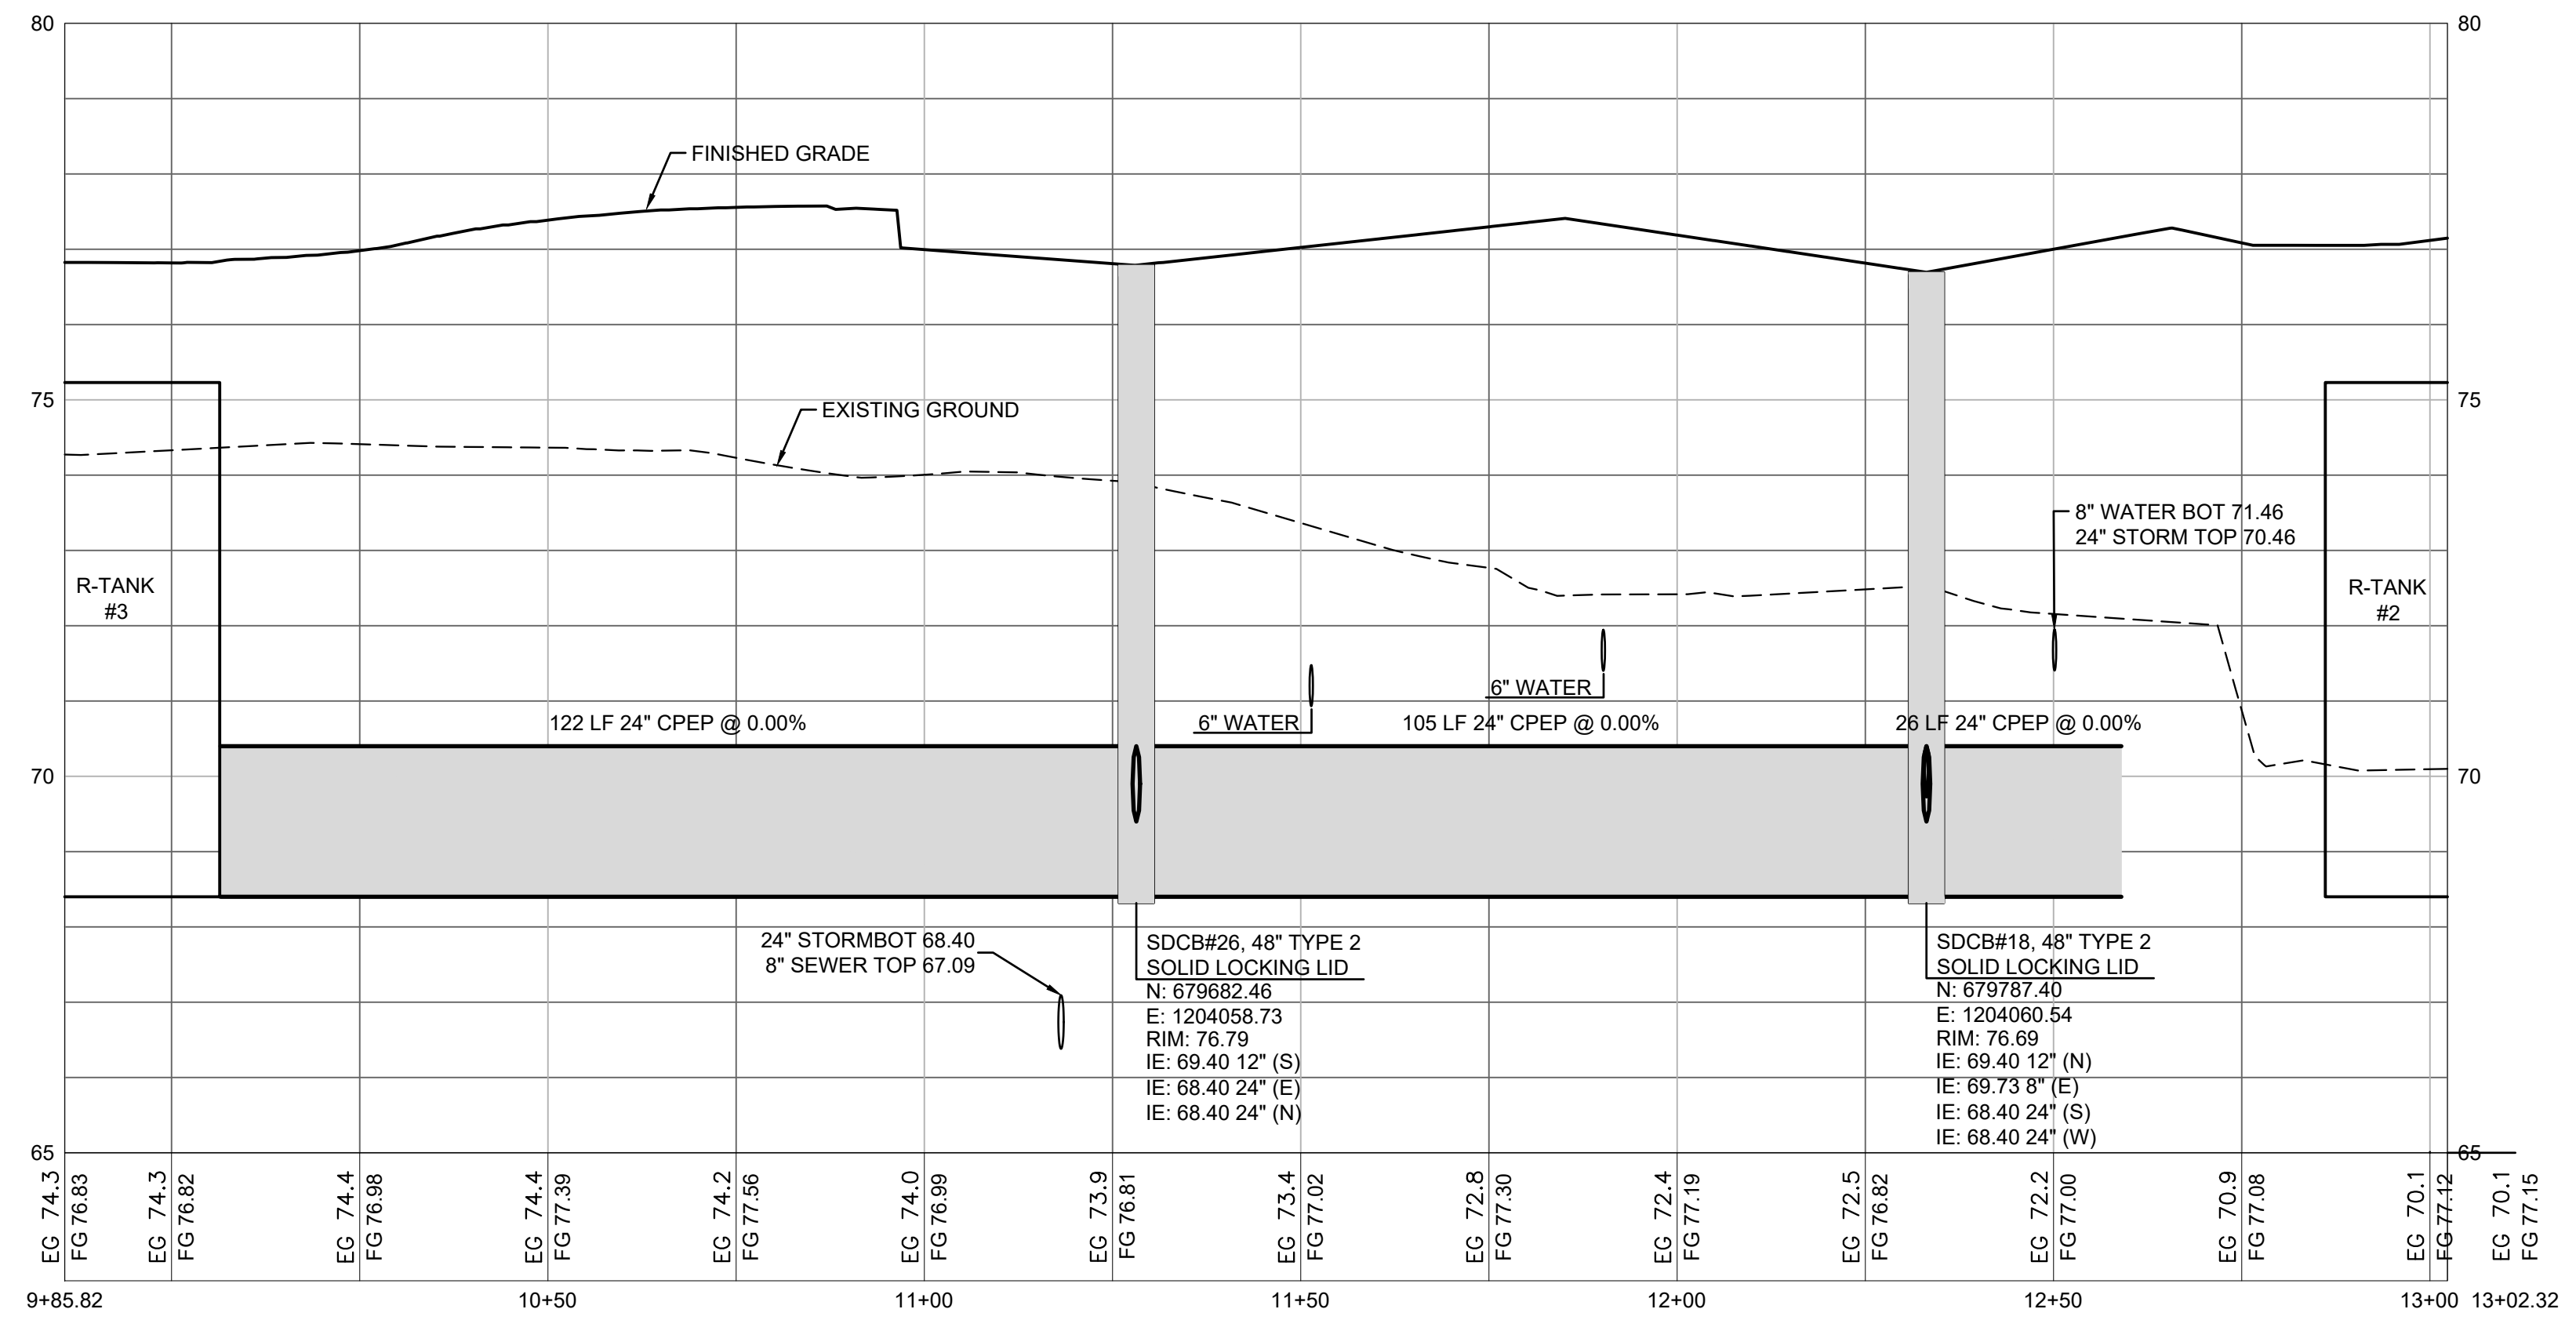


**1 STORM PROFILE**  
 SCALE: HORIZ 1"=20'; VERT 1"=2'

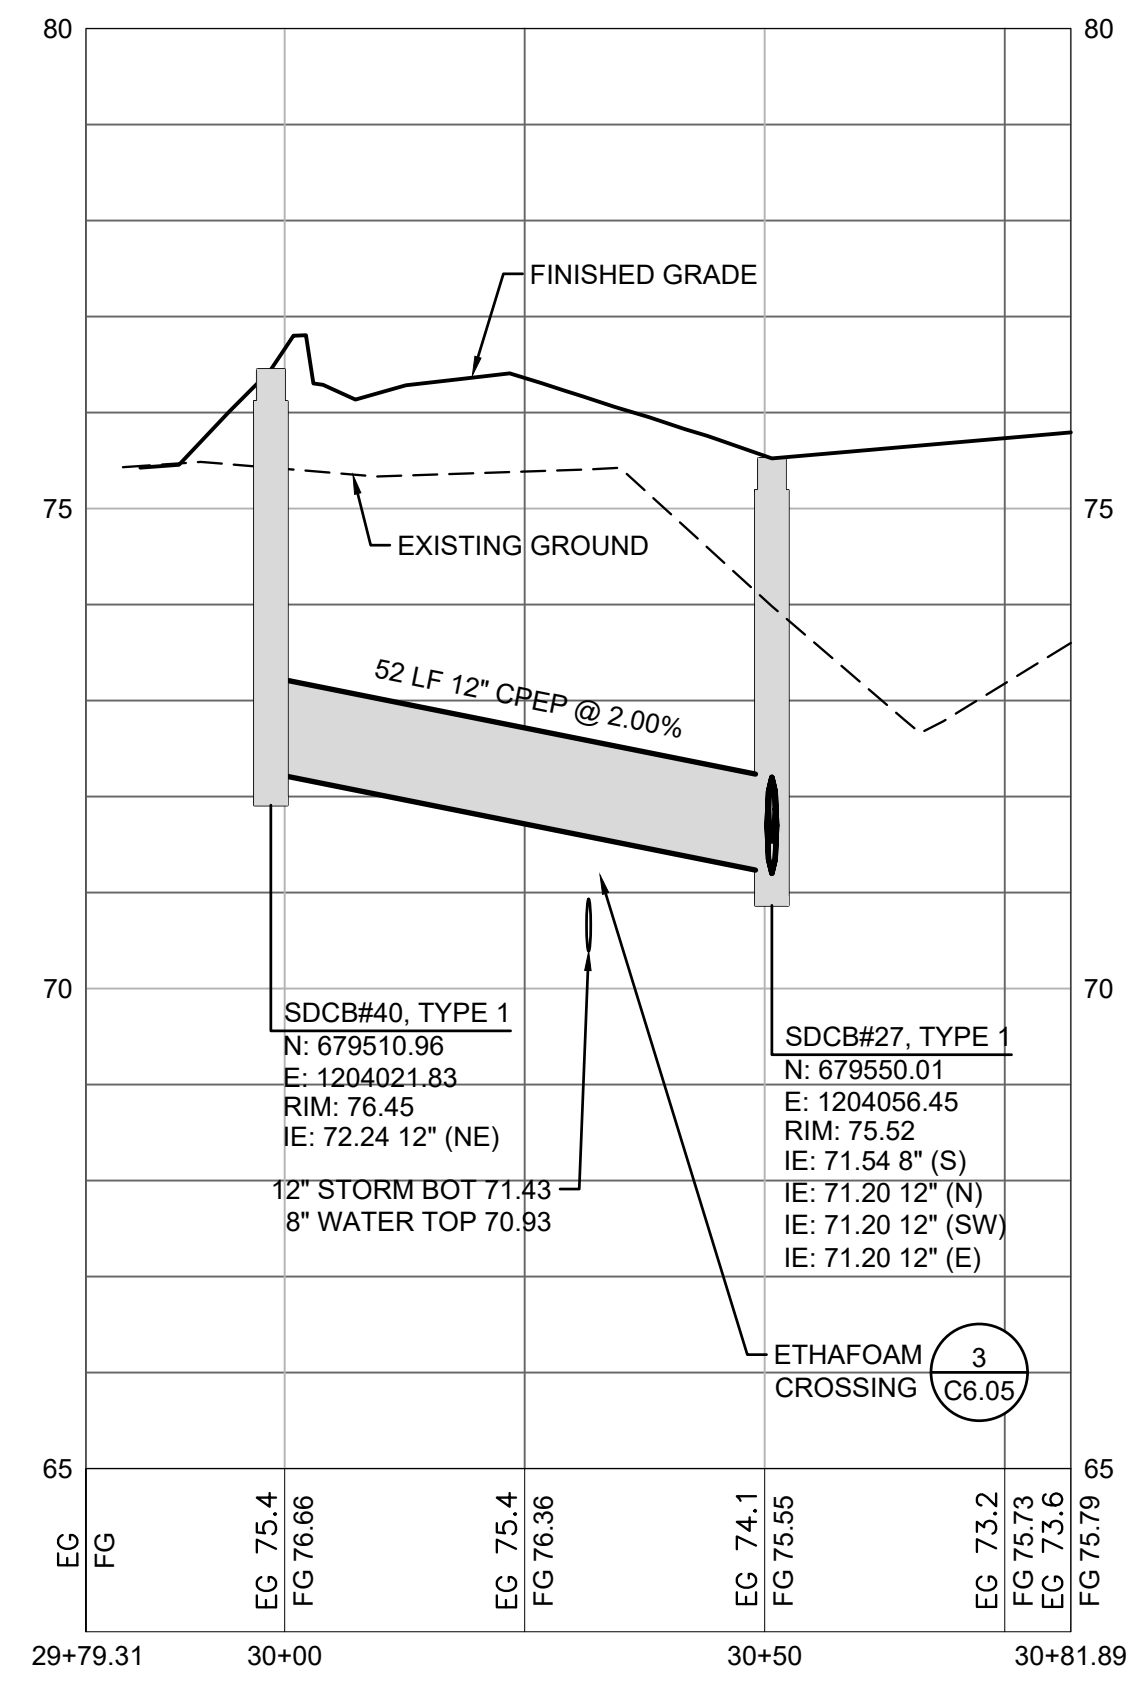

**2 STORM PROFILE**  
 SCALE: HORIZ 1"=20'; VERT 1"=2'

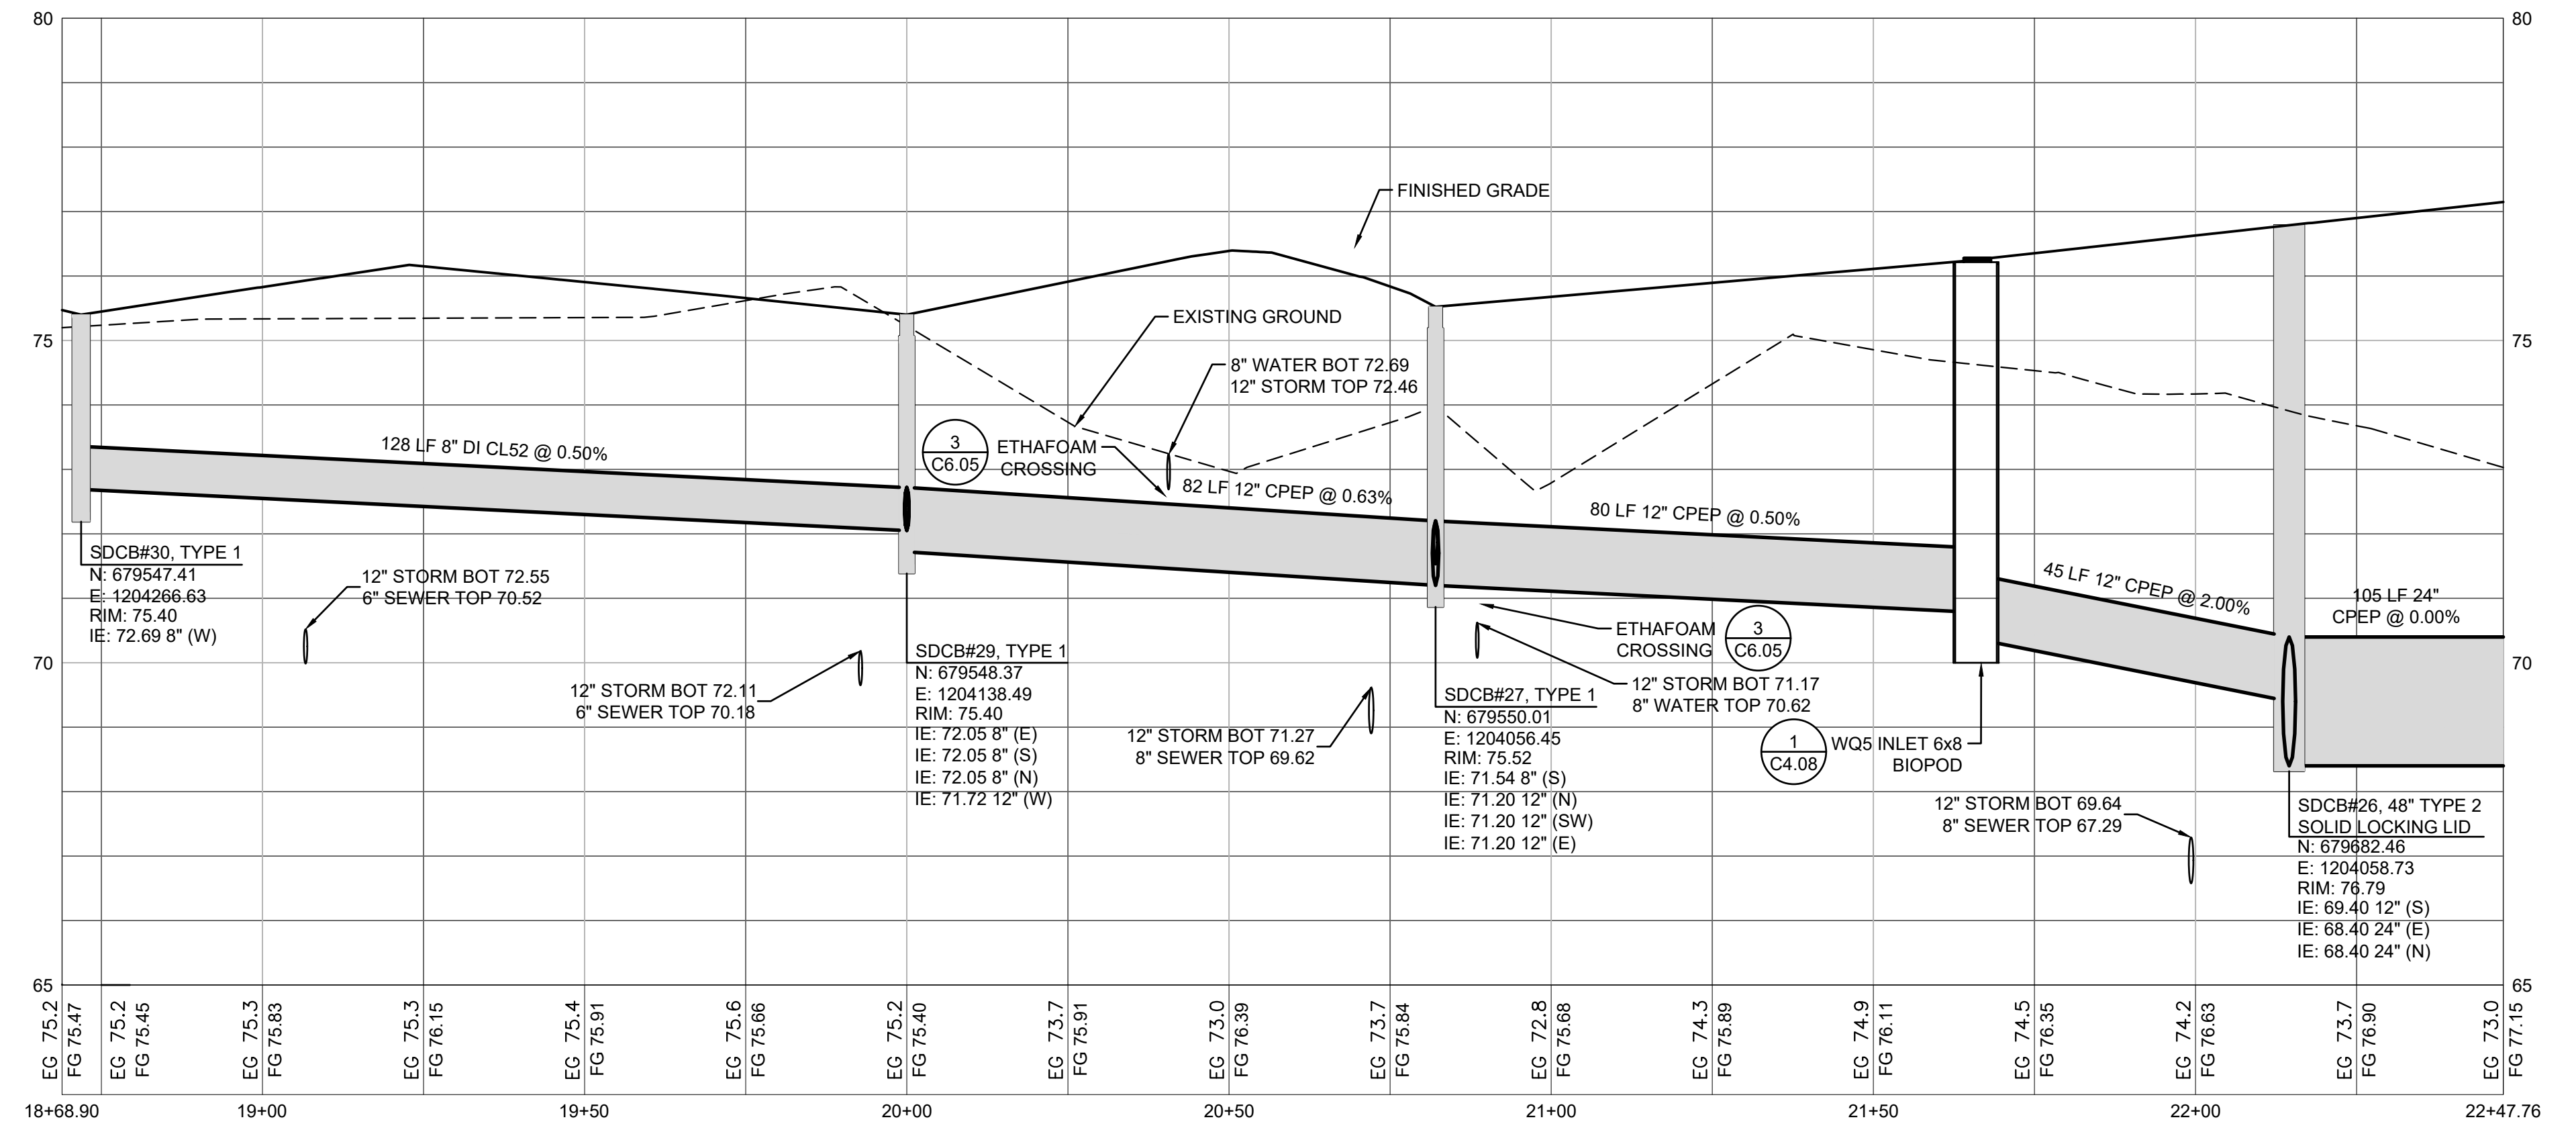

**3 STORM PROFILE**  
 SCALE: HORIZ 1"=20'; VERT 1"=2'

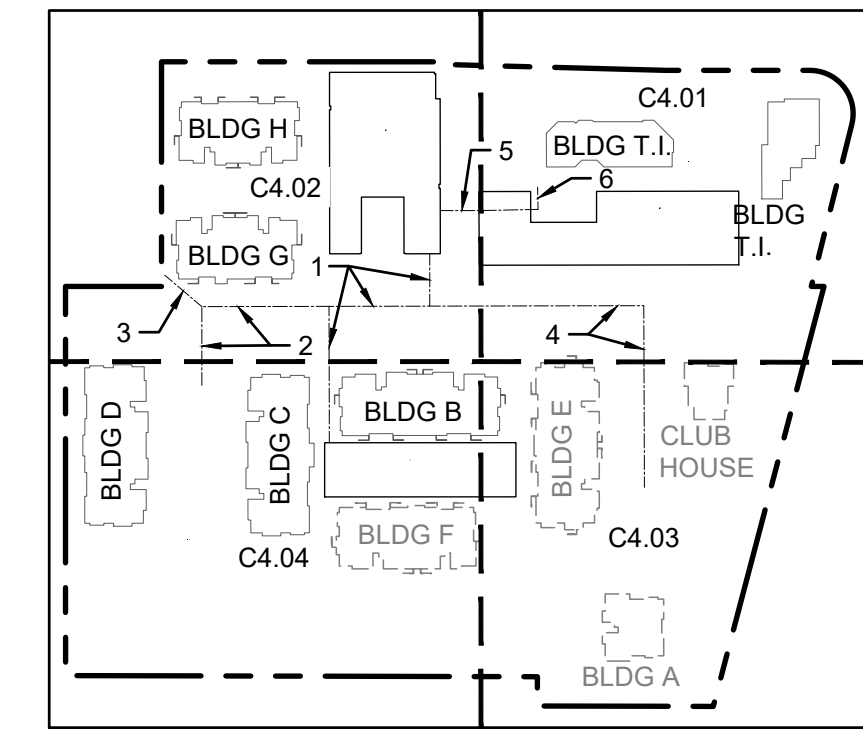

Know what's below.  
 Call before you dig.

Revisions:

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Sheet Title:  
**STORM PROFILES**

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI


Sheet No.  
**C4.05**  
 19 of 53 Sheets




# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.


APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

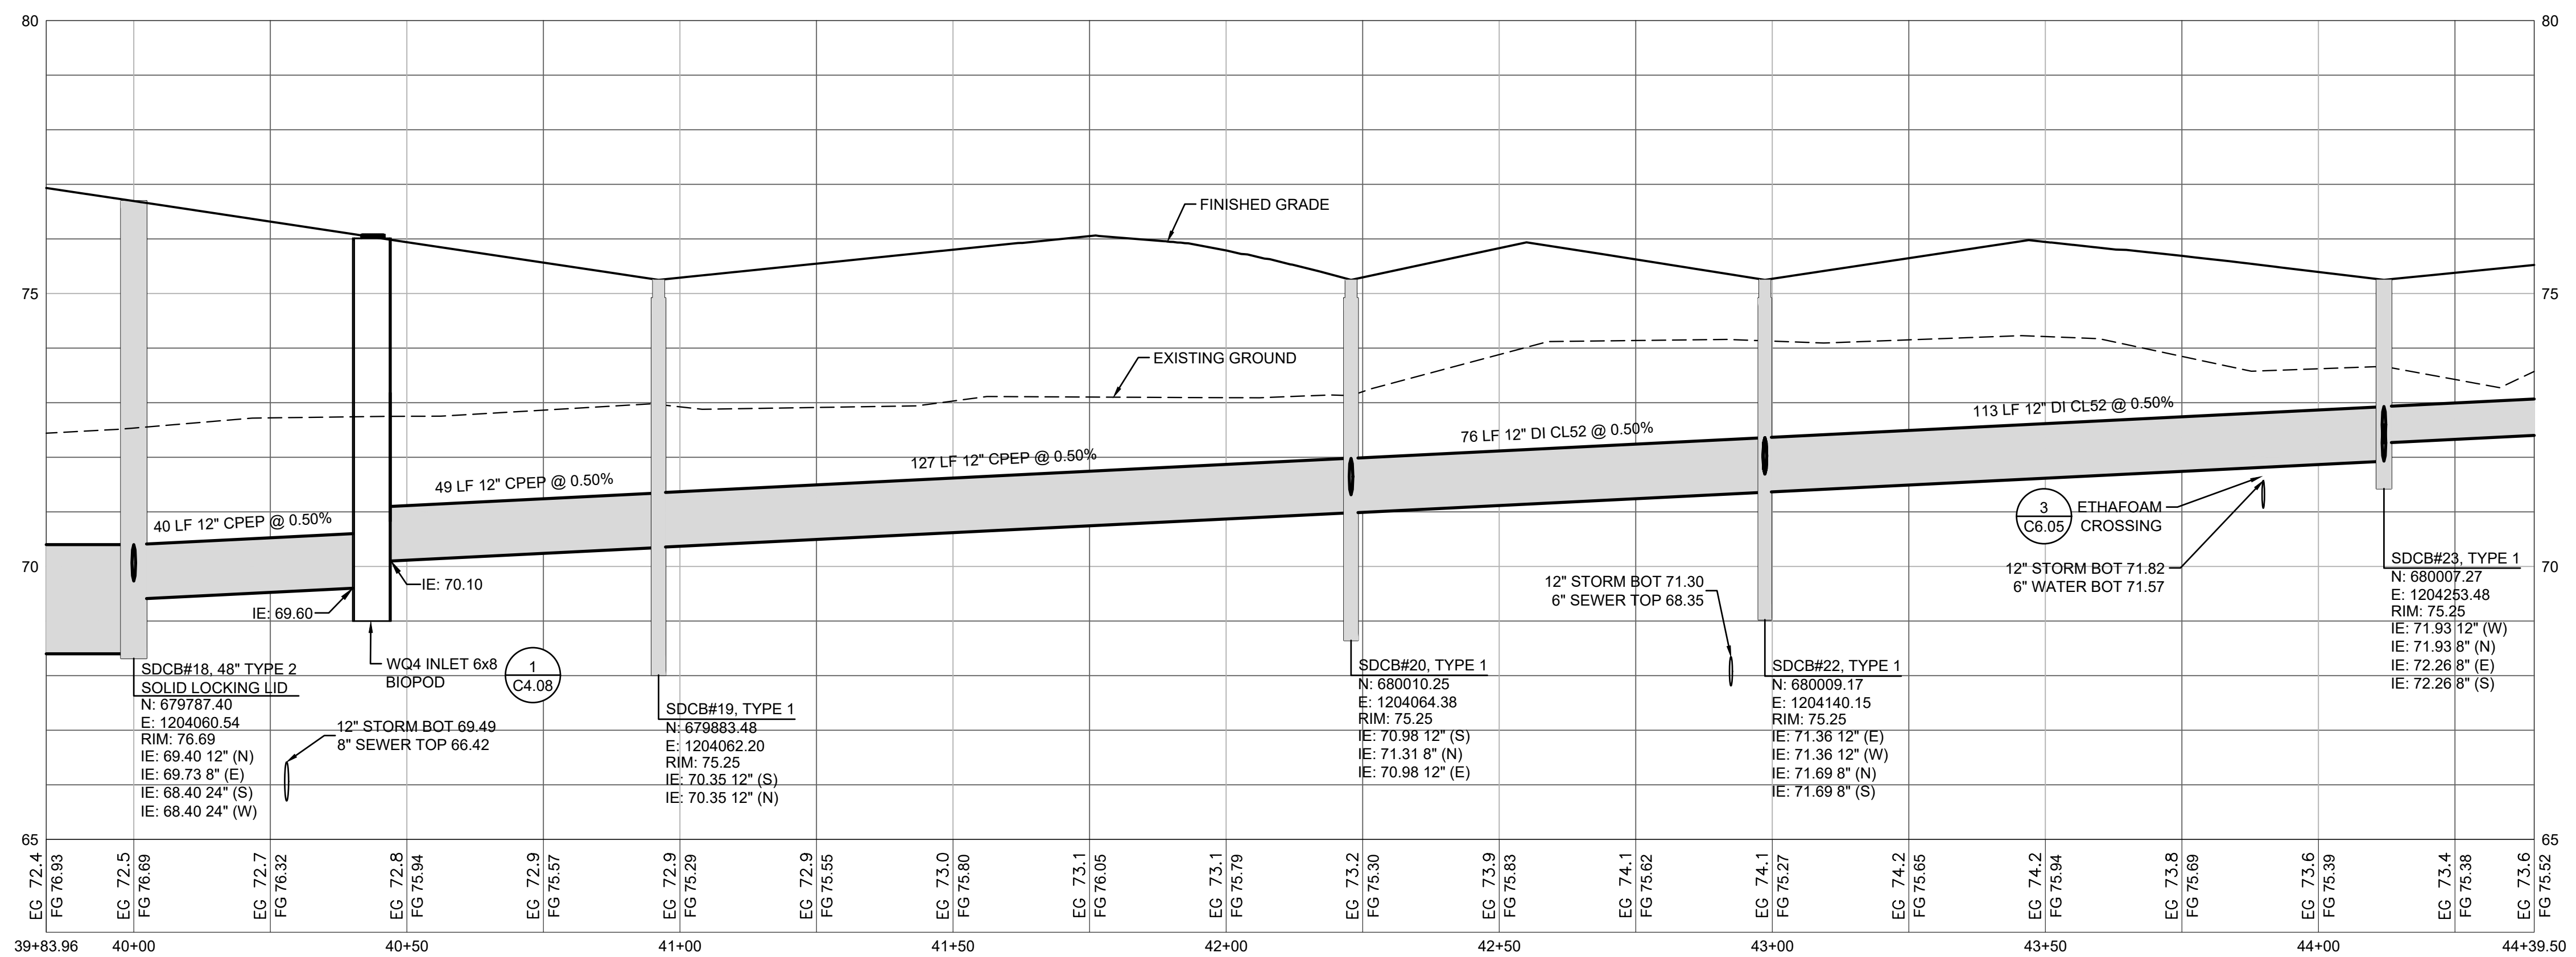


**4 STORM PROFILE**  
 SCALE: HORIZ 1"=20'; VERT 1"=2'

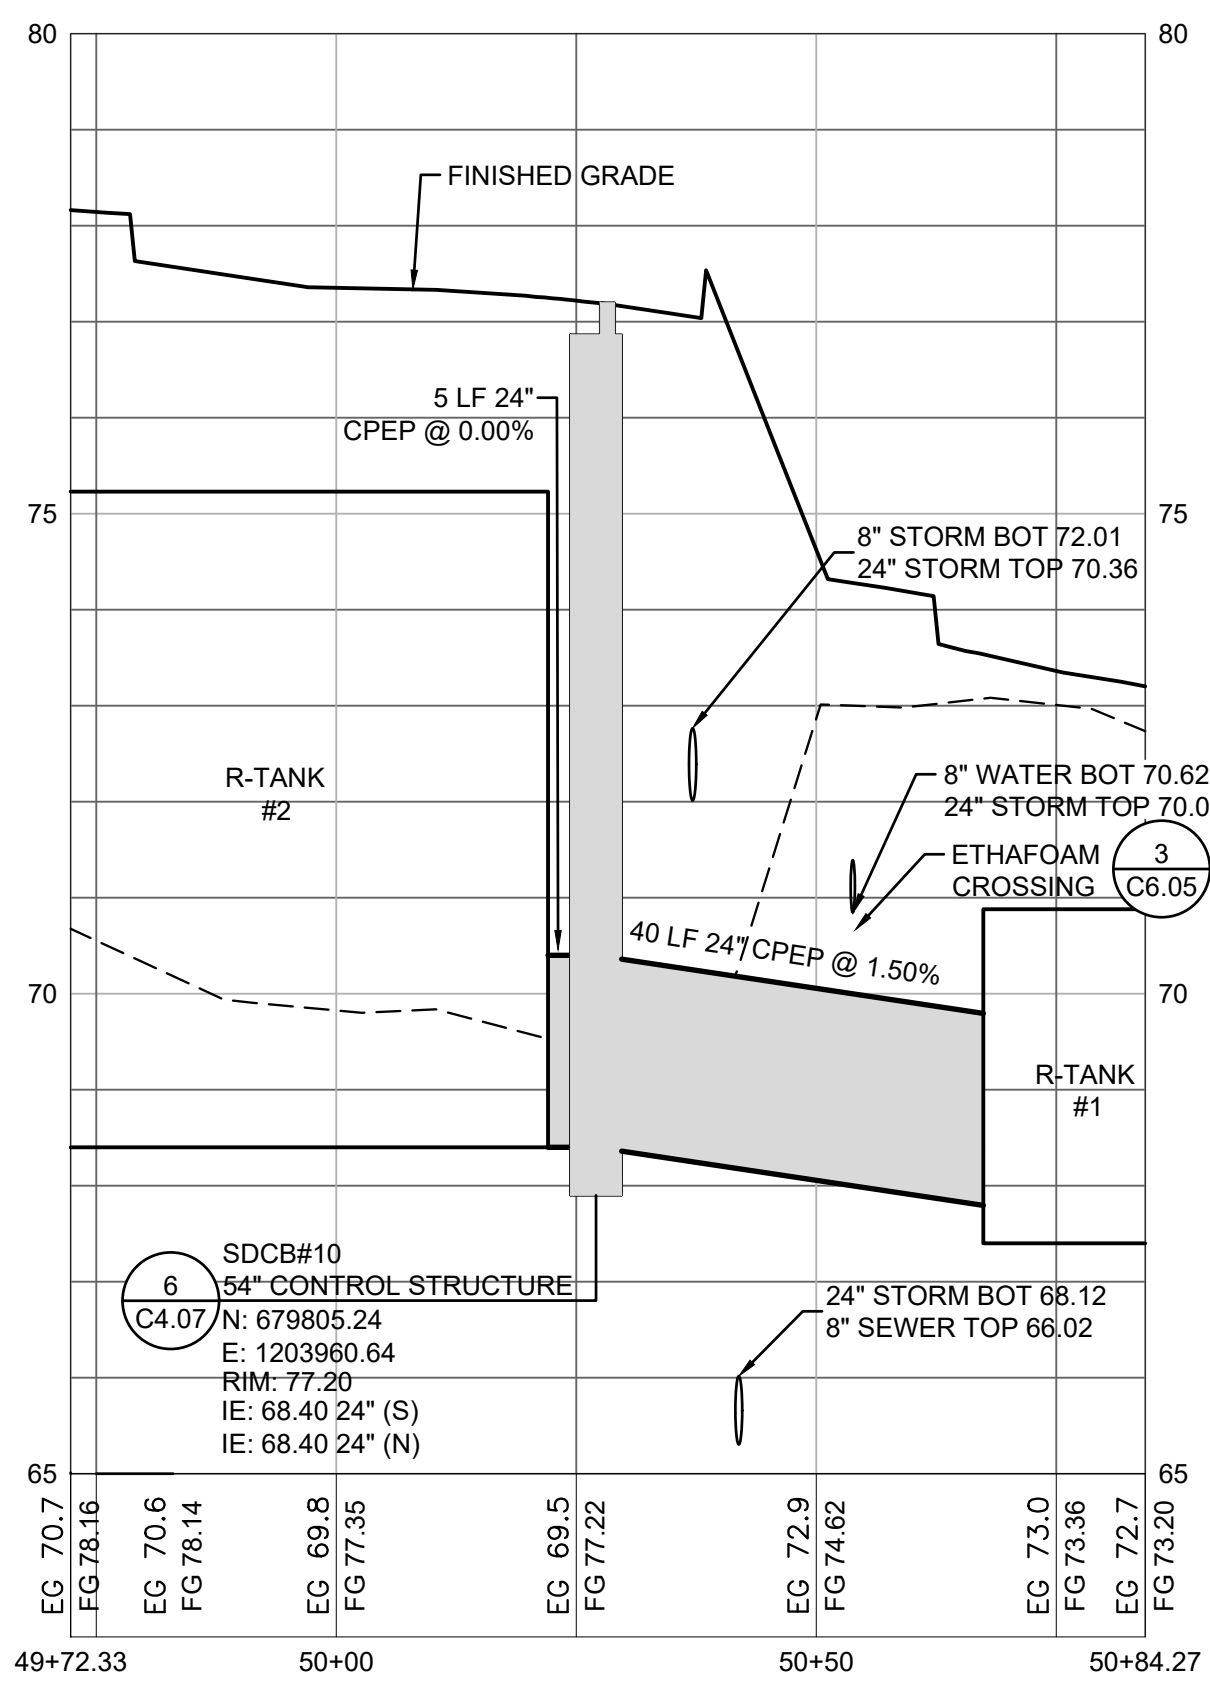

**5 STORM PROFILE**  
 SCALE: HORIZ 1"=20'; VERT 1"=2'

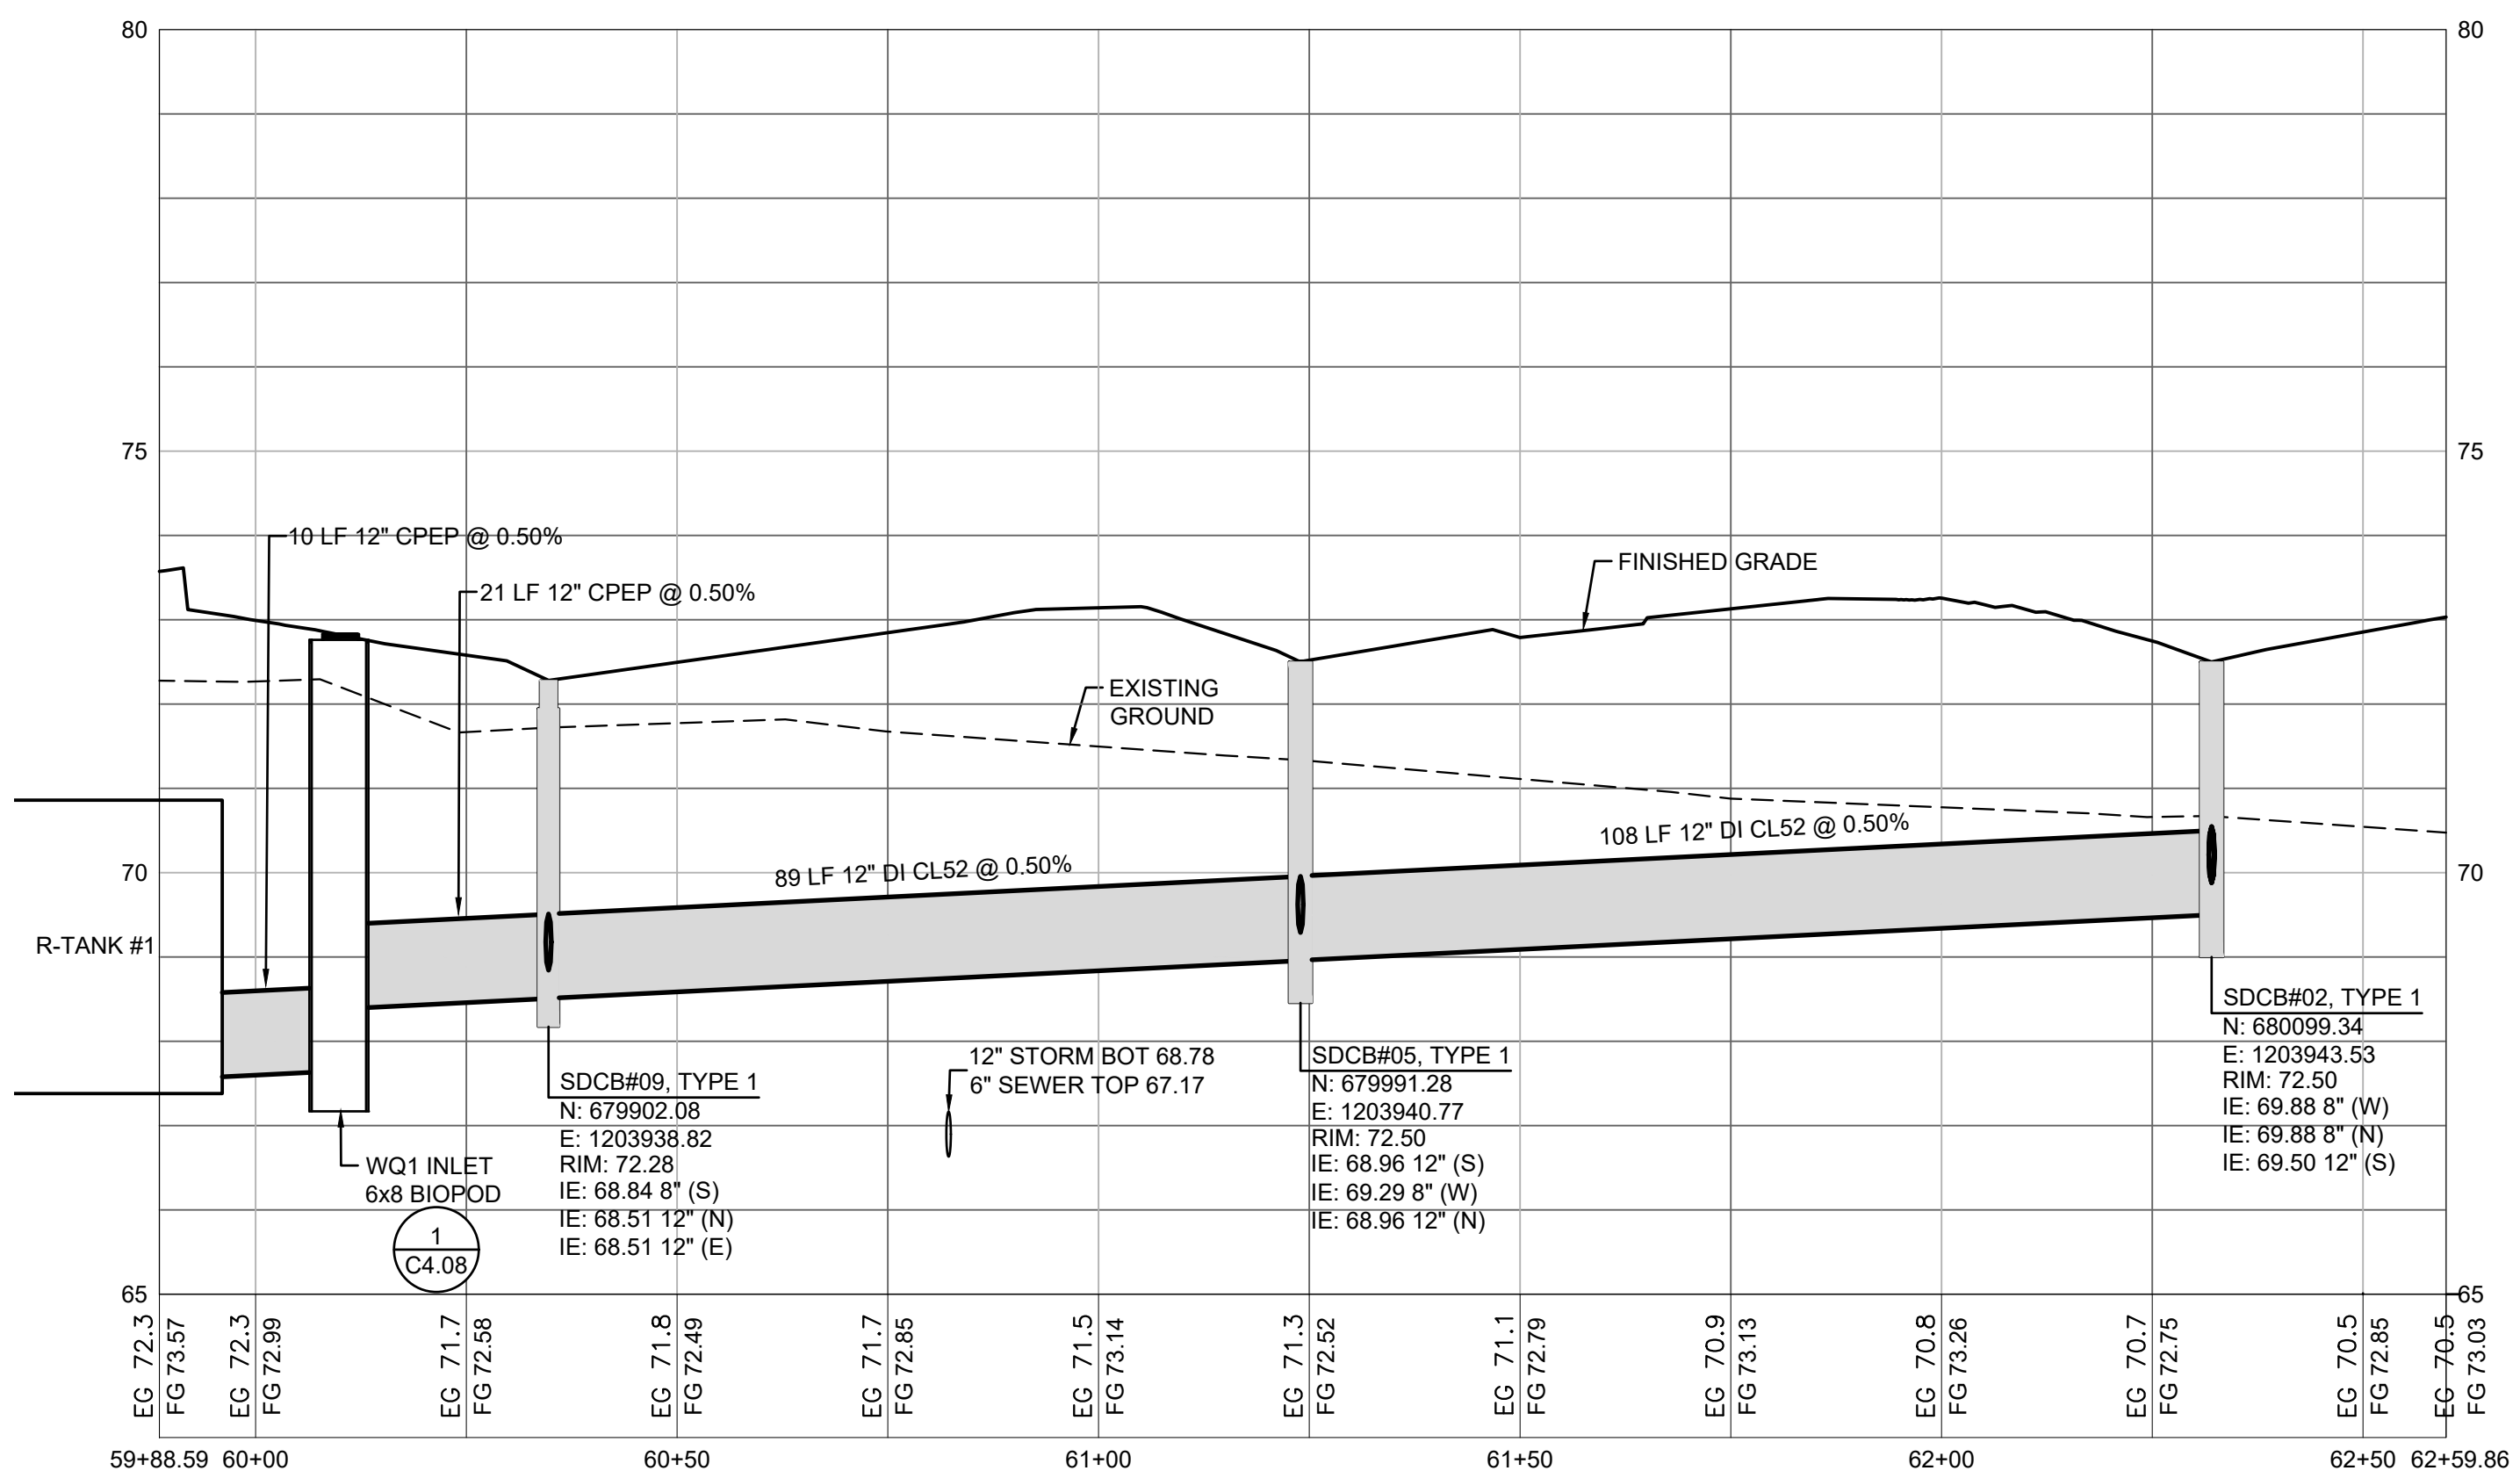

**6 STORM PROFILE**  
 SCALE: HORIZ 1"=20'; VERT 1"=2'

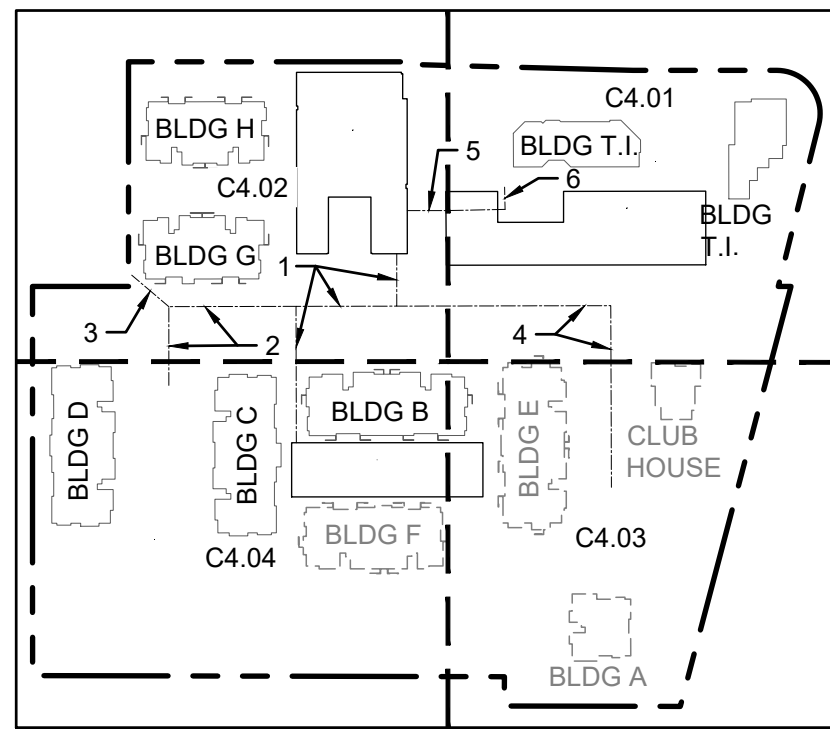

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A PROFESSIONAL ENGINEER'S CERTIFICATION OF THE ACCURACY OF THE INFORMATION CONTAINED HEREIN. THE USER OF THIS DOCUMENT SHALL BE RESPONSIBLE FOR VERIFYING THE ACCURACY OF THE INFORMATION CONTAINED HEREIN. THIS DOCUMENT IS NOT TO BE USED FOR ANY OTHER PROJECT OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title:  
**STORM PROFILES**

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI

Sheet No.  
**C4.06**  
 20 of 53 Sheets






# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
BY: *[Signature]*  
CITY OF PUYALLUP  
DEVELOPMENT ENGINEERING  
DATE: 06/06/2024

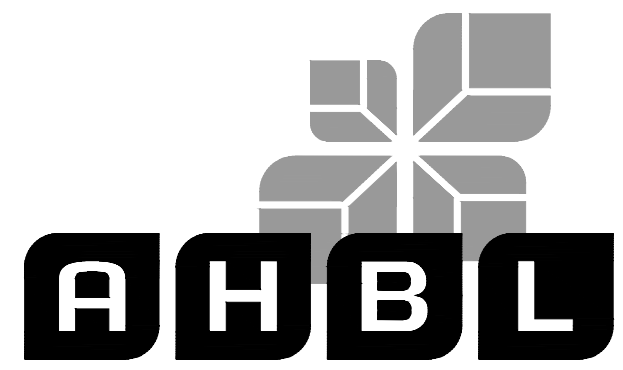

TACOMA • SEATTLE • SPOKANE • TRI-CITIES  
2215 North 30th Street, Suite 300, Tacoma, WA 98403  
253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
**ASH DEVELOPMENT**

GREG HELLE  
GREG.HELLE@ASHNW.COM

Project No.  
2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**

05/17/2024



NOTICE  
ALLEGATION OF THIS DOCUMENT SHALL INDICATE THE PROFESSIONAL SEAL AND SIGNATURE OF THE REGISTERED PROFESSIONAL ENGINEER. THE REGISTERED PROFESSIONAL ENGINEER SHALL BE RESPONSIBLE FOR THE PROJECT ENTIRETY IN THE TITLE BLOCK AND NOT TO BE USED FOR OTHER PROJECTS OR ADDITION TO THAT PROJECT FOR ANY OTHER PROJECT.

City of Puyallup  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS  
01/29/24 CITY COMMENTS  
Revisions:

Sheet Title:


# STORM DRAINAGE NOTES AND DETAILS

Designed by: CW  
Drawn by: SK/RS  
Checked by: JI


Sheet No.

**C4.07**


21 of 53 Sheets

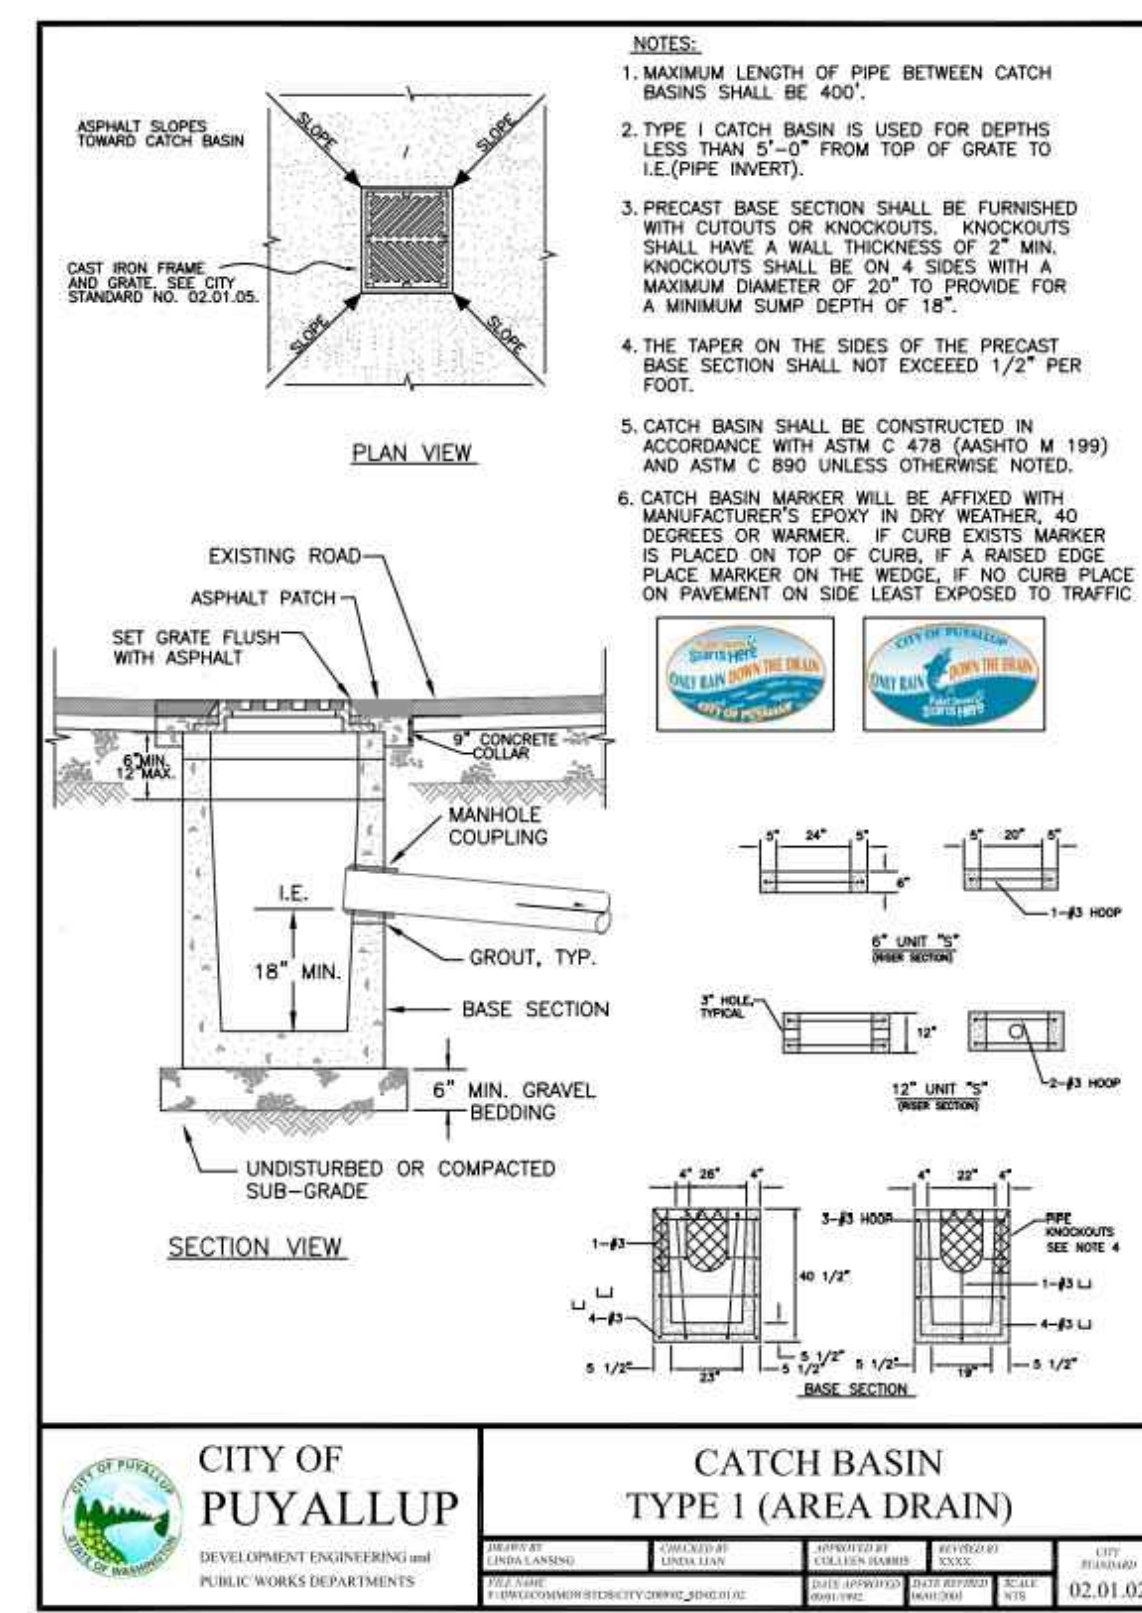


**1 CATCH BASIN TYPE 1 (AREA DRAIN)**  
NOT TO SCALE

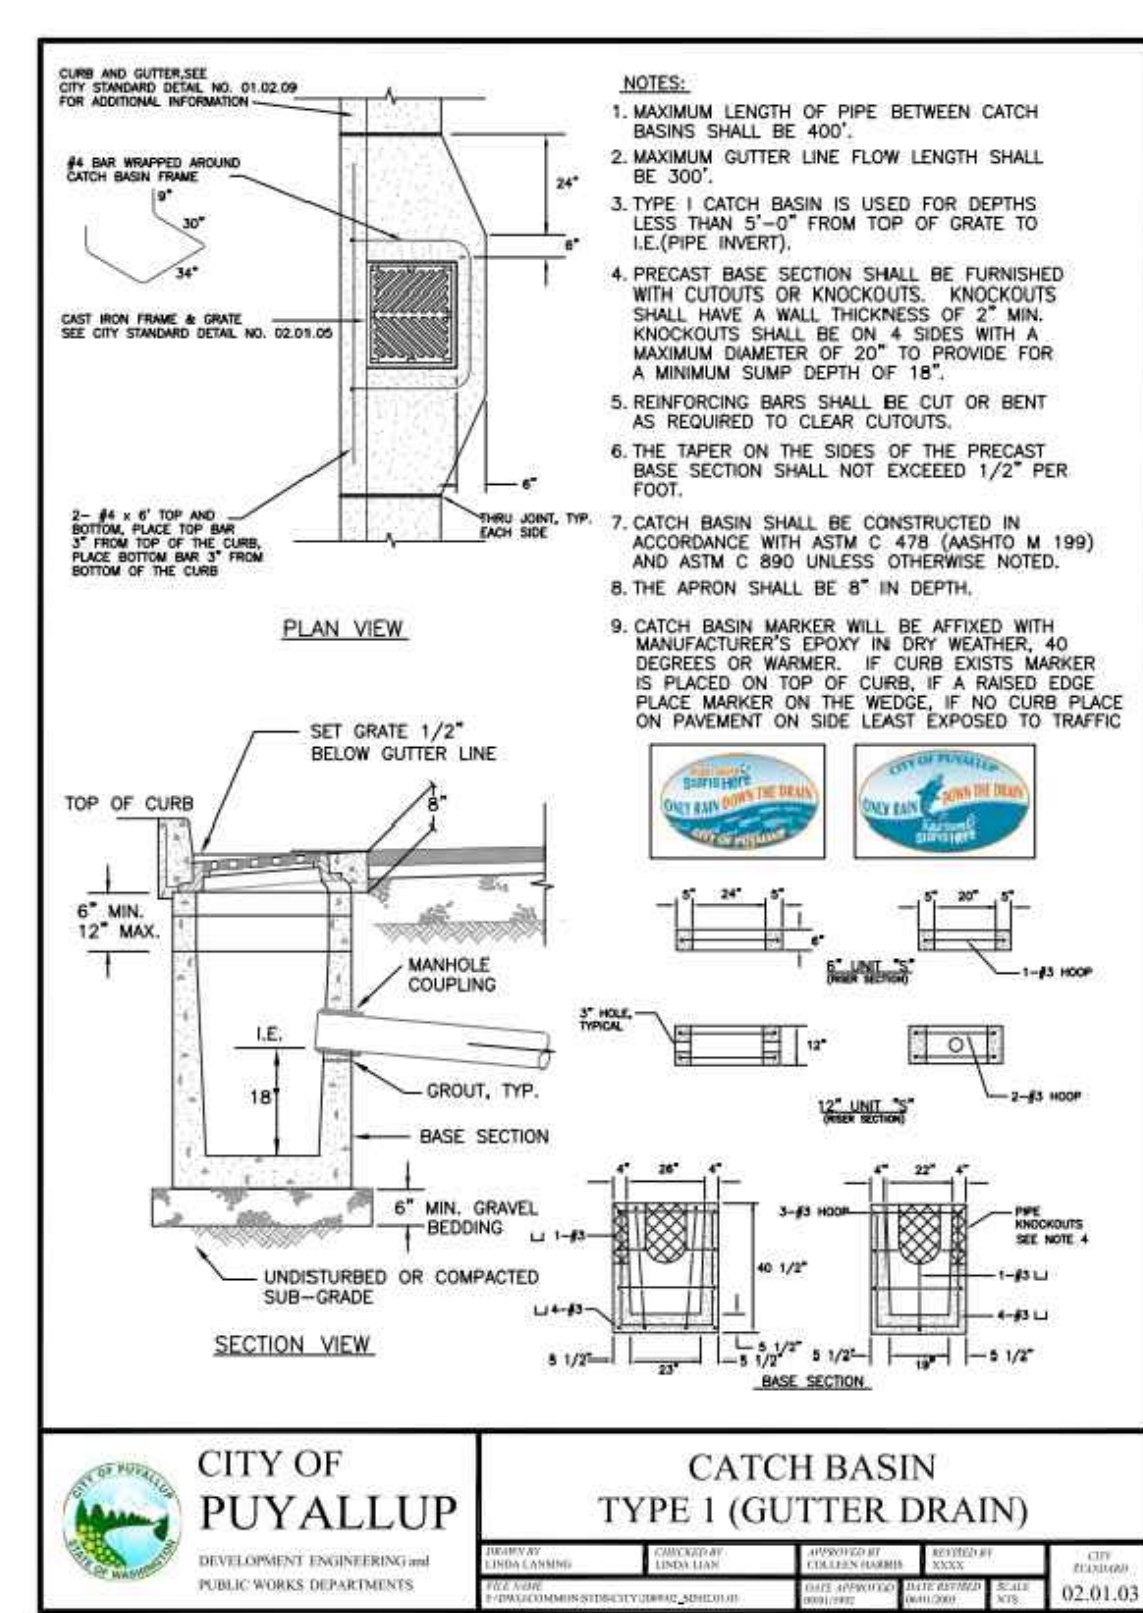


**2 CATCH BASIN TYPE 1 (GUTTER DRAIN)**  
NOT TO SCALE

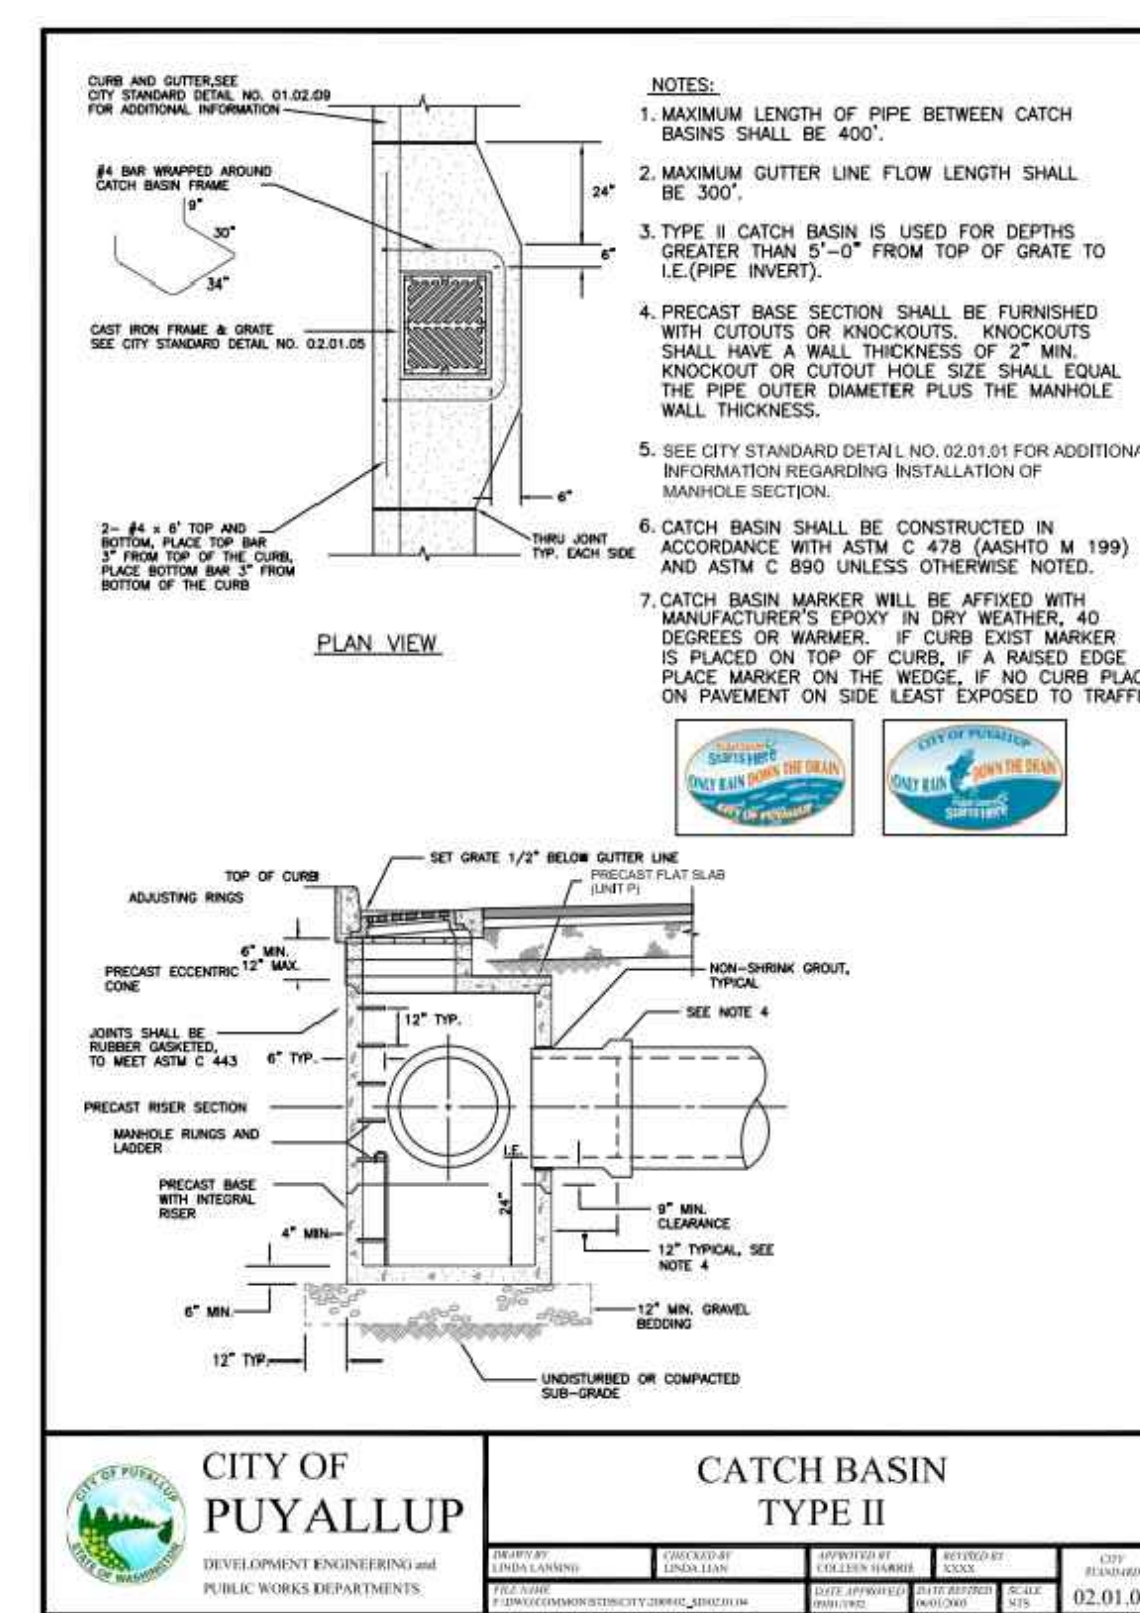


**3 CATCH BASIN TYPE II**  
NOT TO SCALE

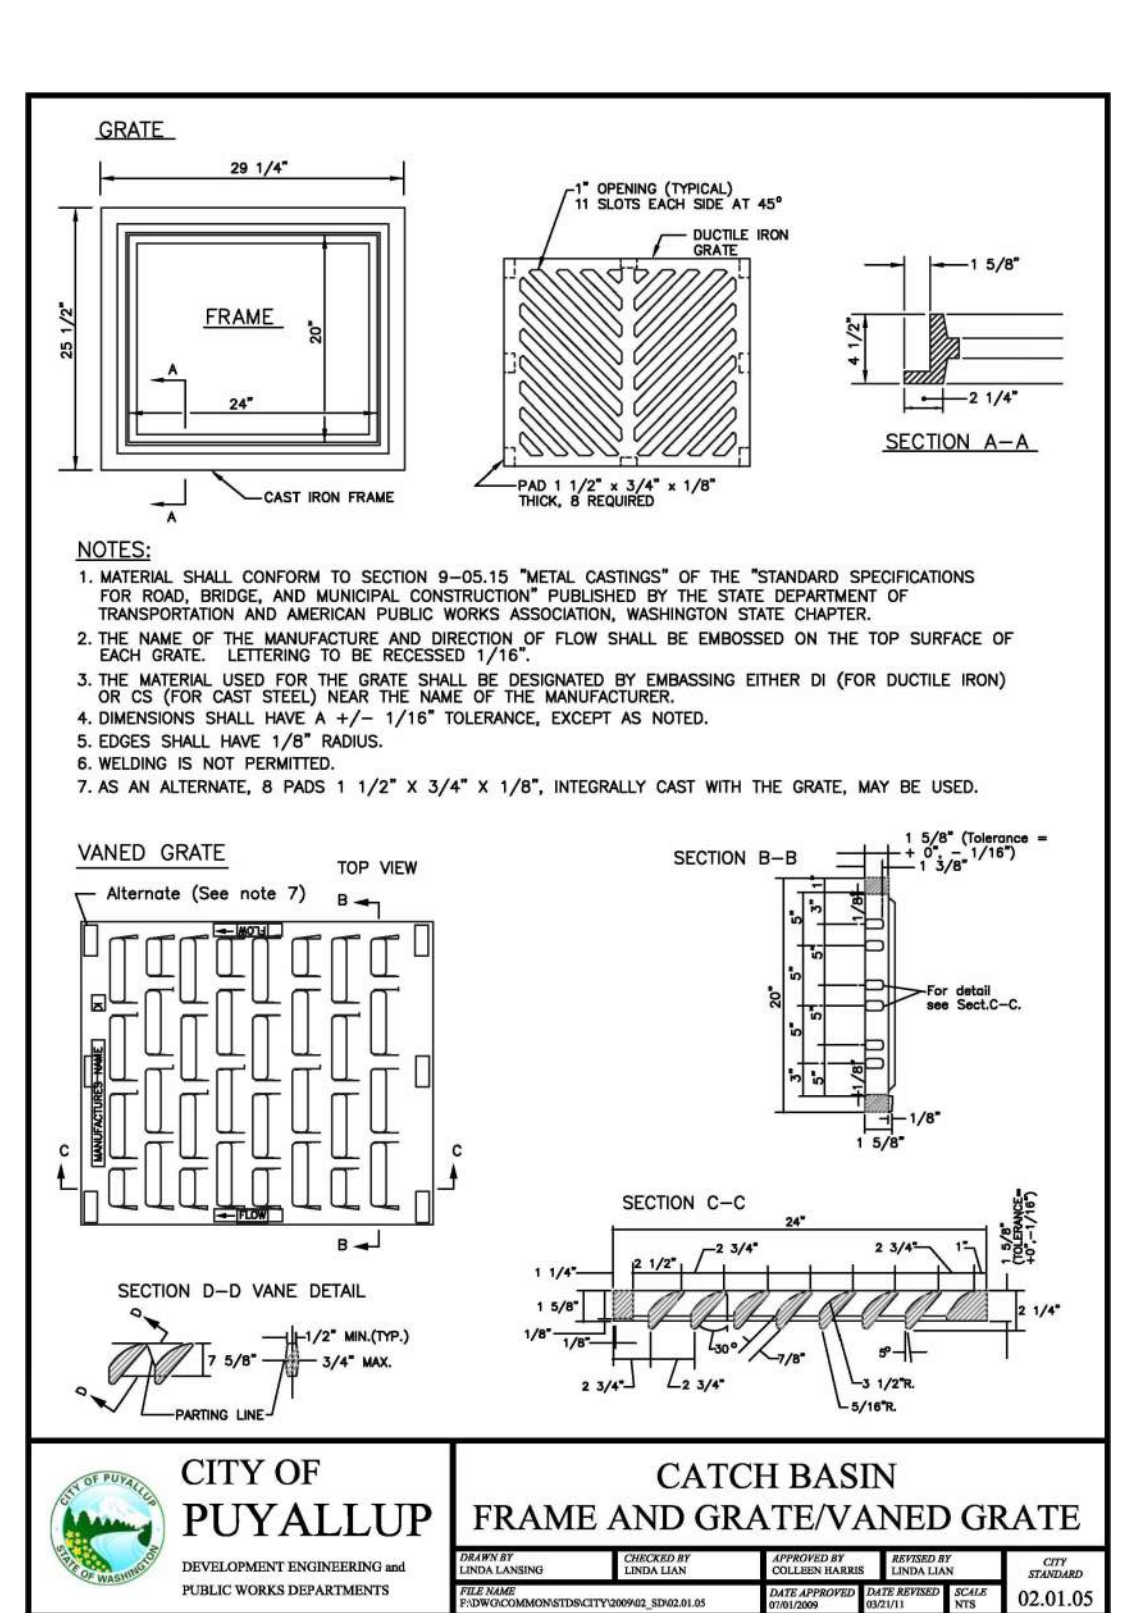


**4 CATCH BASIN FRAME AND GRATE**  
NOT TO SCALE

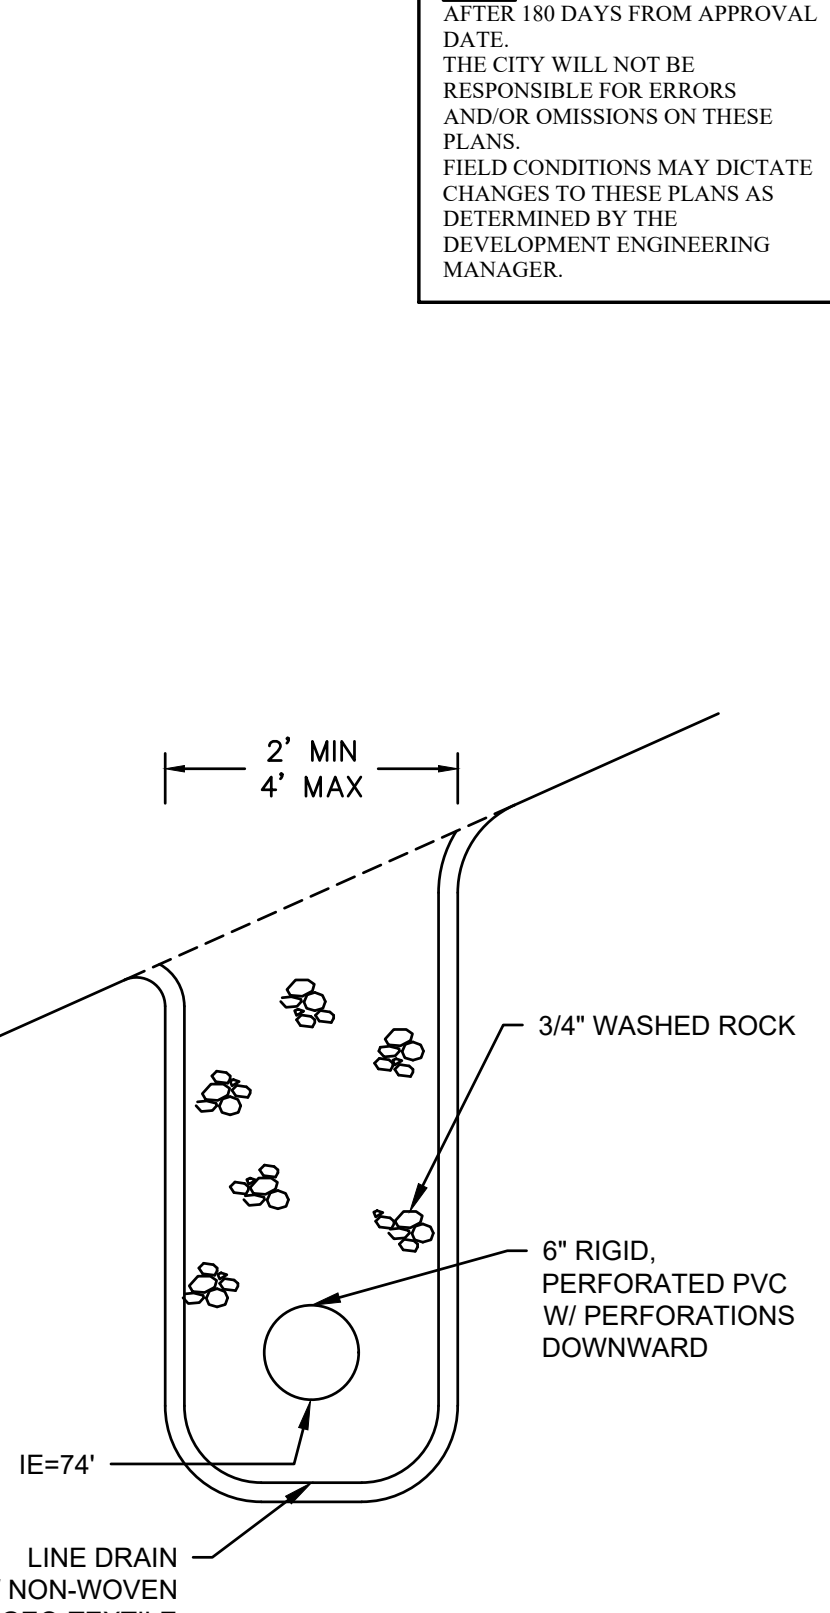


**5 FRENCH DRAIN DETAIL**  
NOT TO SCALE

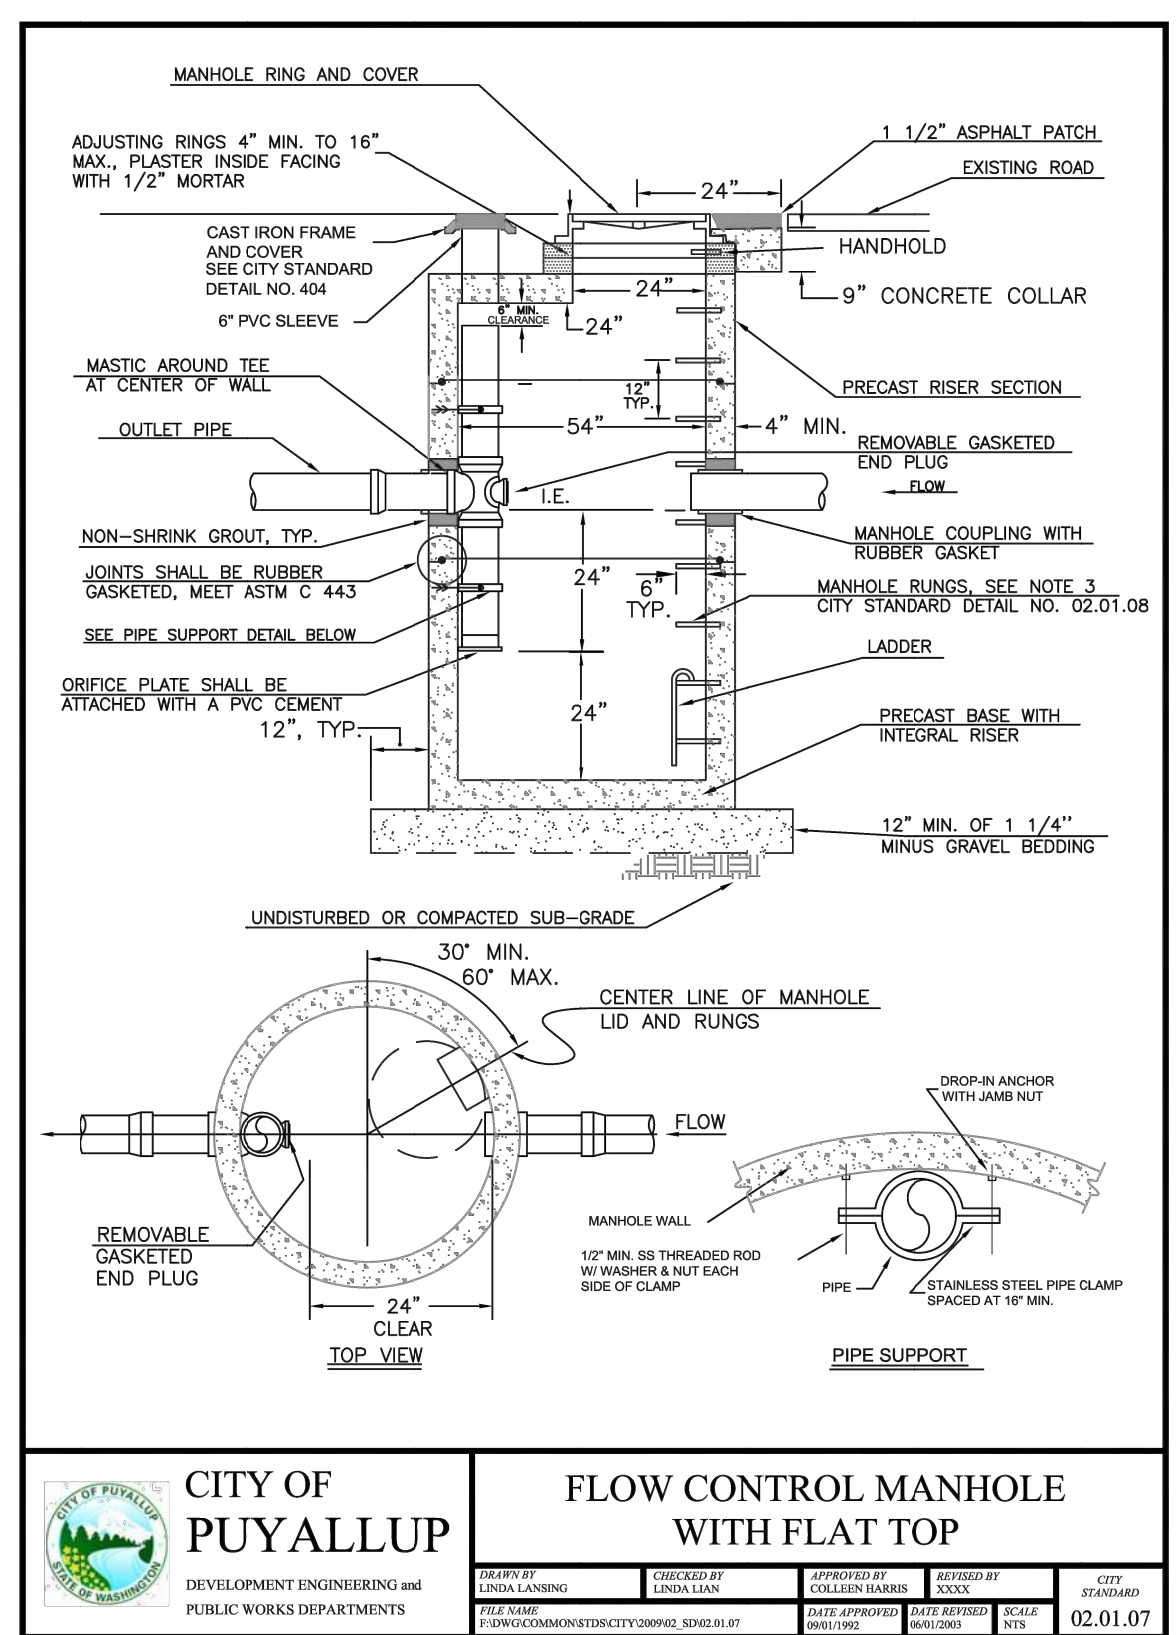


**6 FLOW CONTROL MANHOLE WITH FLAT TOP (AND DATA TABLE)**  
NOT TO SCALE

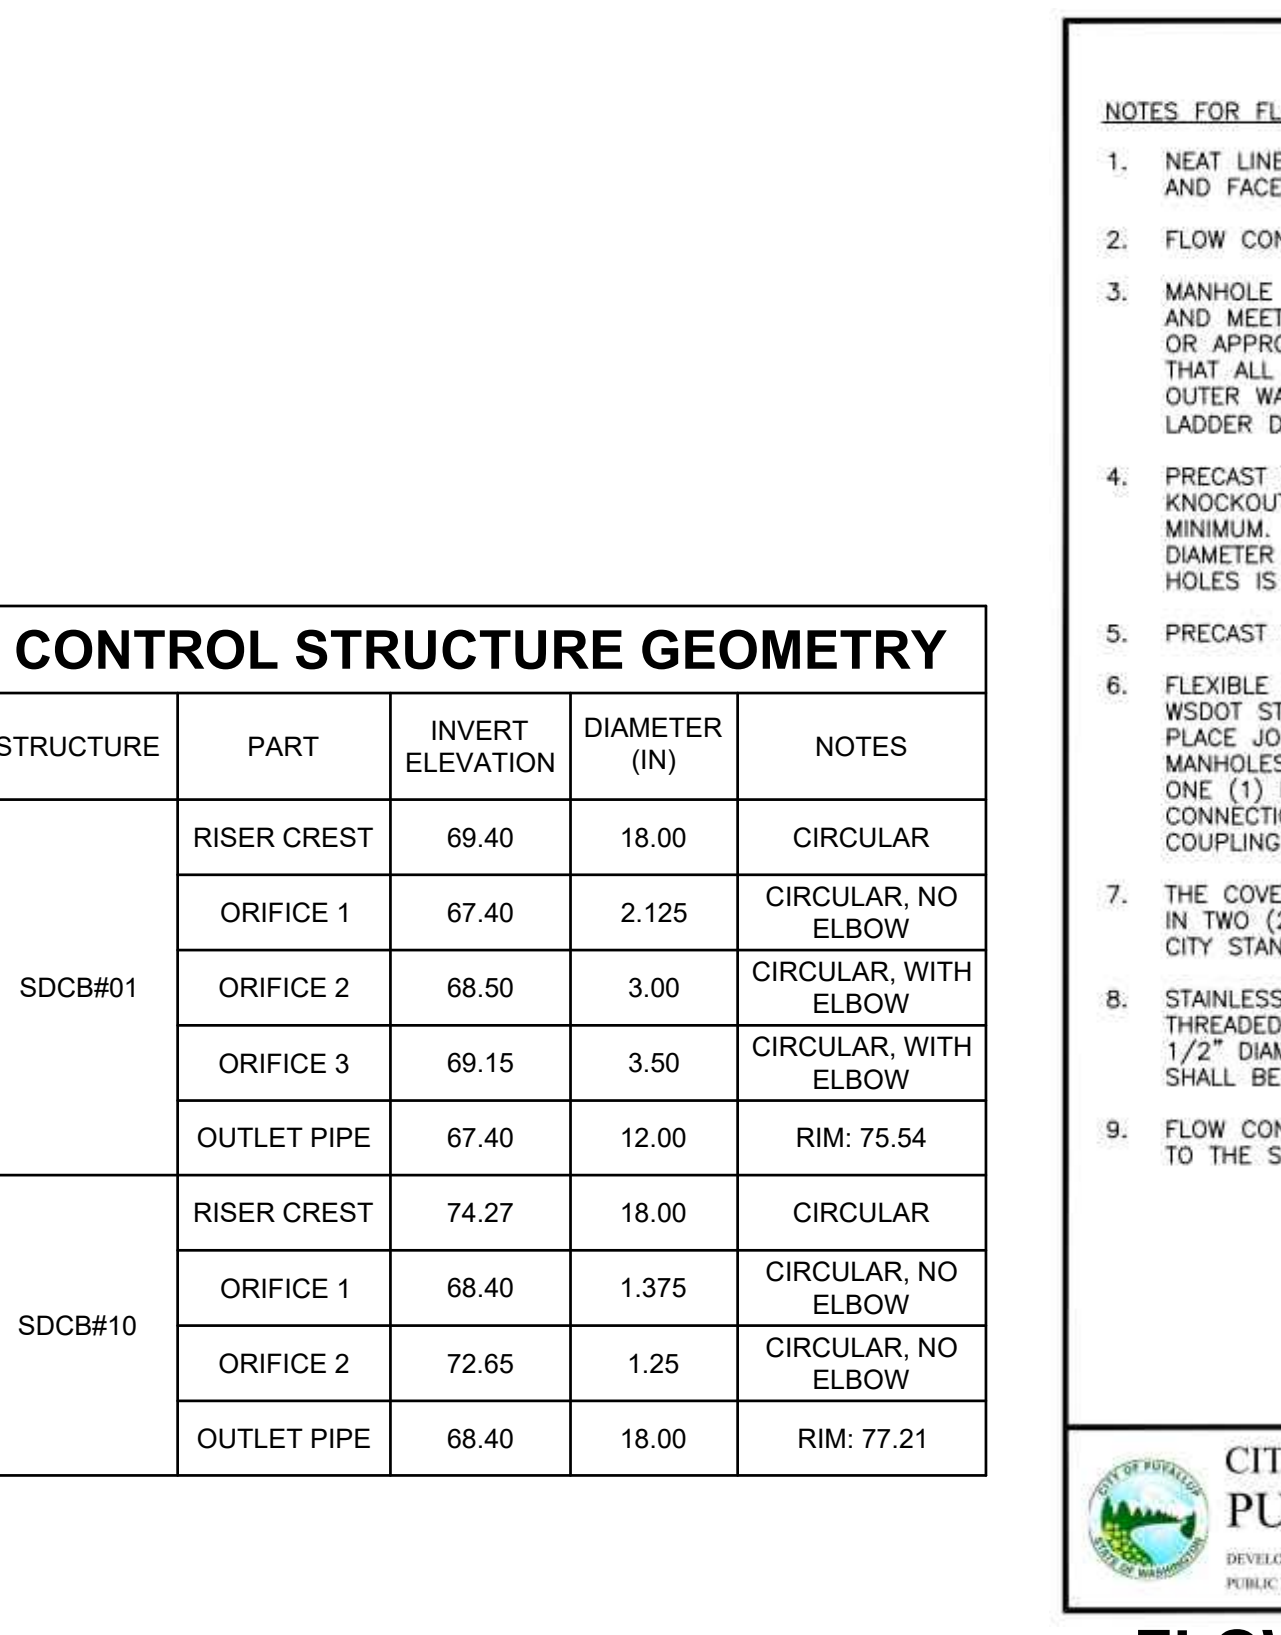

**7 FLOW CONTROL MANHOLE NOTES**  
NOT TO SCALE

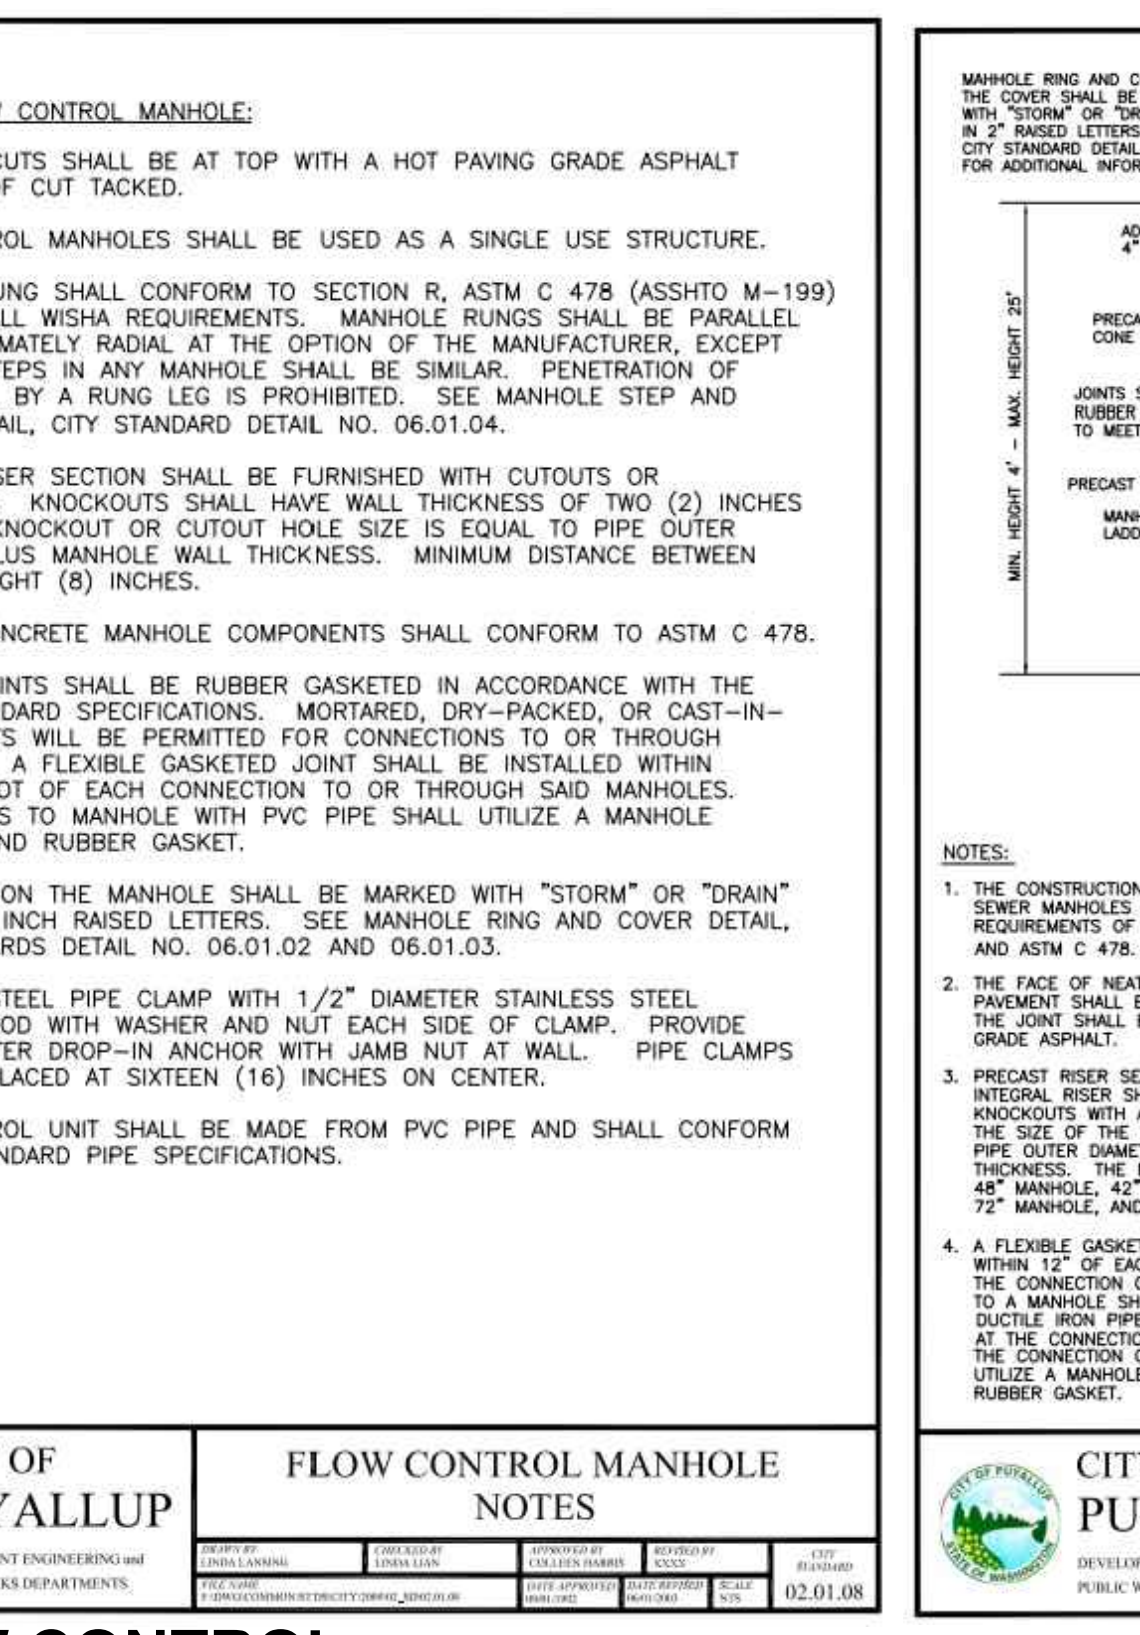

**8 STORM SEWER MANHOLE**  
NOT TO SCALE

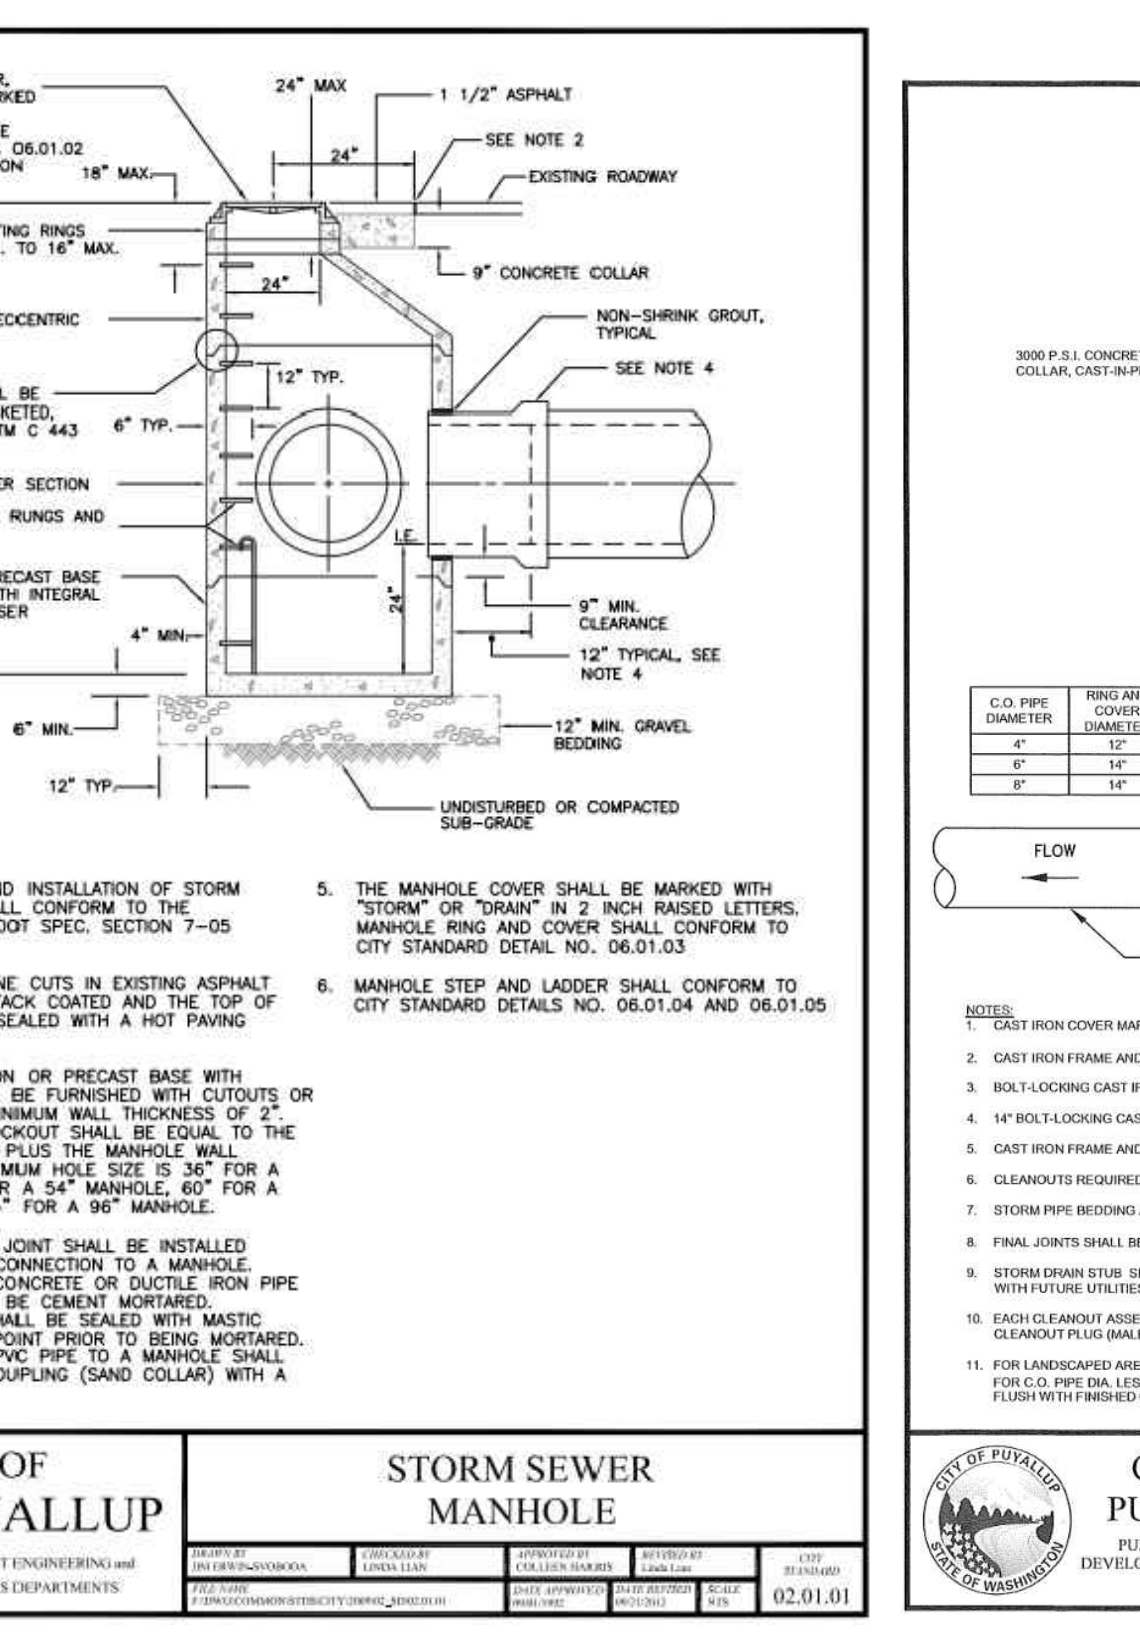

**9 STORM DRAIN CLEANOUT**  
NOT TO SCALE



Know what's below.  
Call before you dig.



# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED

BY:   
CITY OF PUYALLUP  
DEVELOPMENT ENGINEERING

DATE: 06/06/2024


NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.




SITE SPECIFIC DATA				
Structure ID	ID			
Treatment Flow Rate (cfs)	0.12 CFS			
Peak Flow Rate (cfs)	4 CFS			
Rim Elevation				
Top of Vault Elevation				
Pipe Data	Pipe Location	Pipe Size	Pipe Type	Invert Elevation
Inlet				
Outlet				
Notes: SEE TABLE BELOW FOR DATA				
PERFORMANCE SPECIFICATIONS				
Treatment Flow Capacities:*				
NJDEP 80% Removal, 75 micron	0.144 cfs			
WA Ecology GULD - Basic, Enhanced & Phosphorus	0.128 cfs			
Bypass Capacity	5.0 cfs			
<small>*Contact Oldcastle for alternative treatment flow capacities.</small>				

6x8 BIOPOD				
NUMBER	1	3	4	5
RIM	72.78	76.52	76.07	76.28
TOP OF VAULT ELEVATION	72.83	76.15	75.86	75.90
INLET LOCATION	W	S	N	S
PIPE SIZE	12"	12"	12"	12"
PIPE TYPE	CPEP	CPEP	CPEP	CPEP
INLET IE	68.40	71.65	70.10	70.80
OUTLET LOCATION	S	N	S	N
PIPE SIZE	12"	12"	12"	12"
PIPE TYPE	CPEP	CPEP	CPEP	CPEP
OUTLET IE	67.63	68.90	69.60	70.30

WQ DEVICE #2 IS A 4x6 BIOPOD. REFER TO SHEET C4.09 FOR SIZING.

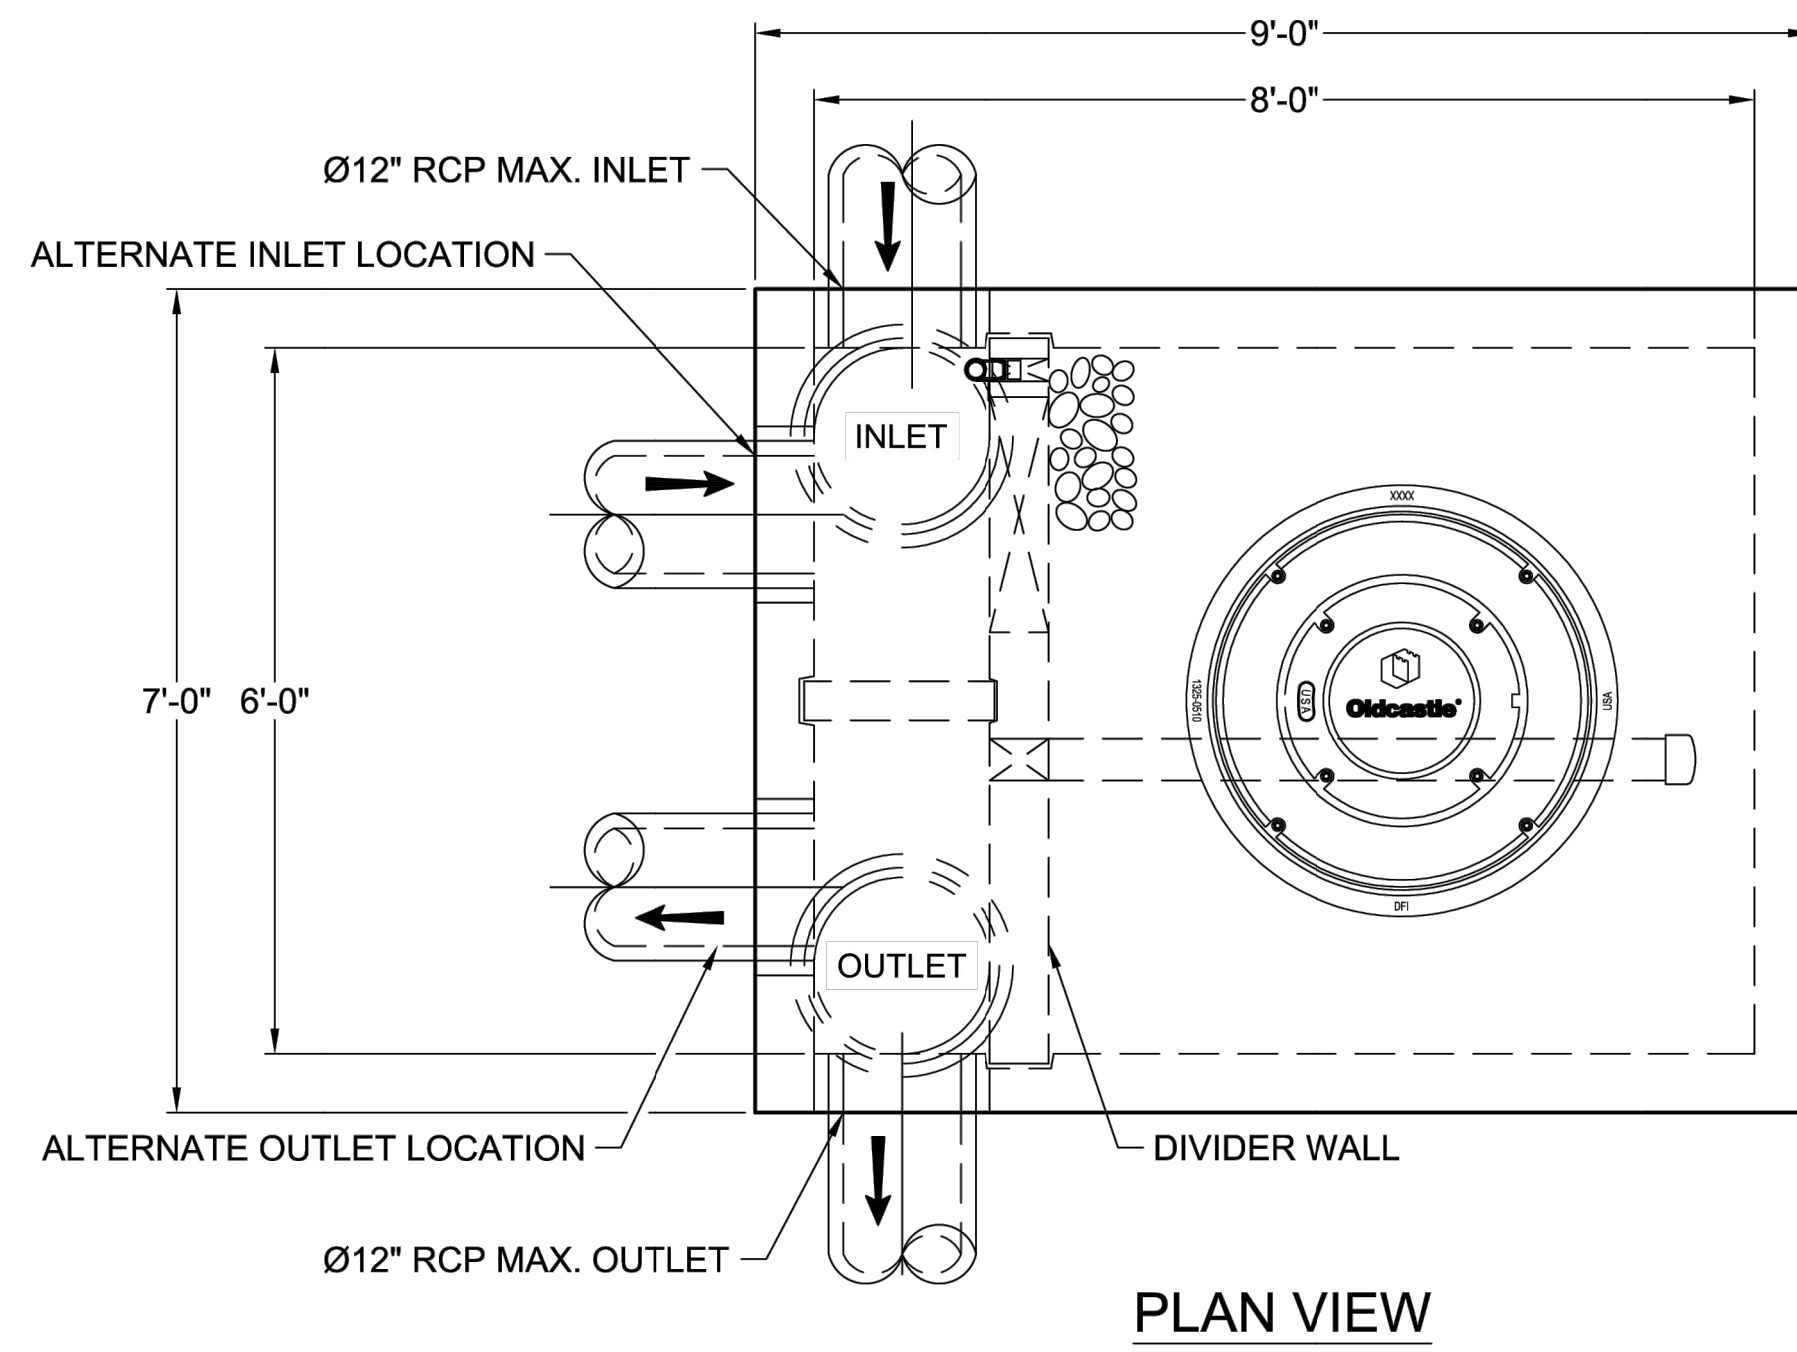


PLAN VIEW

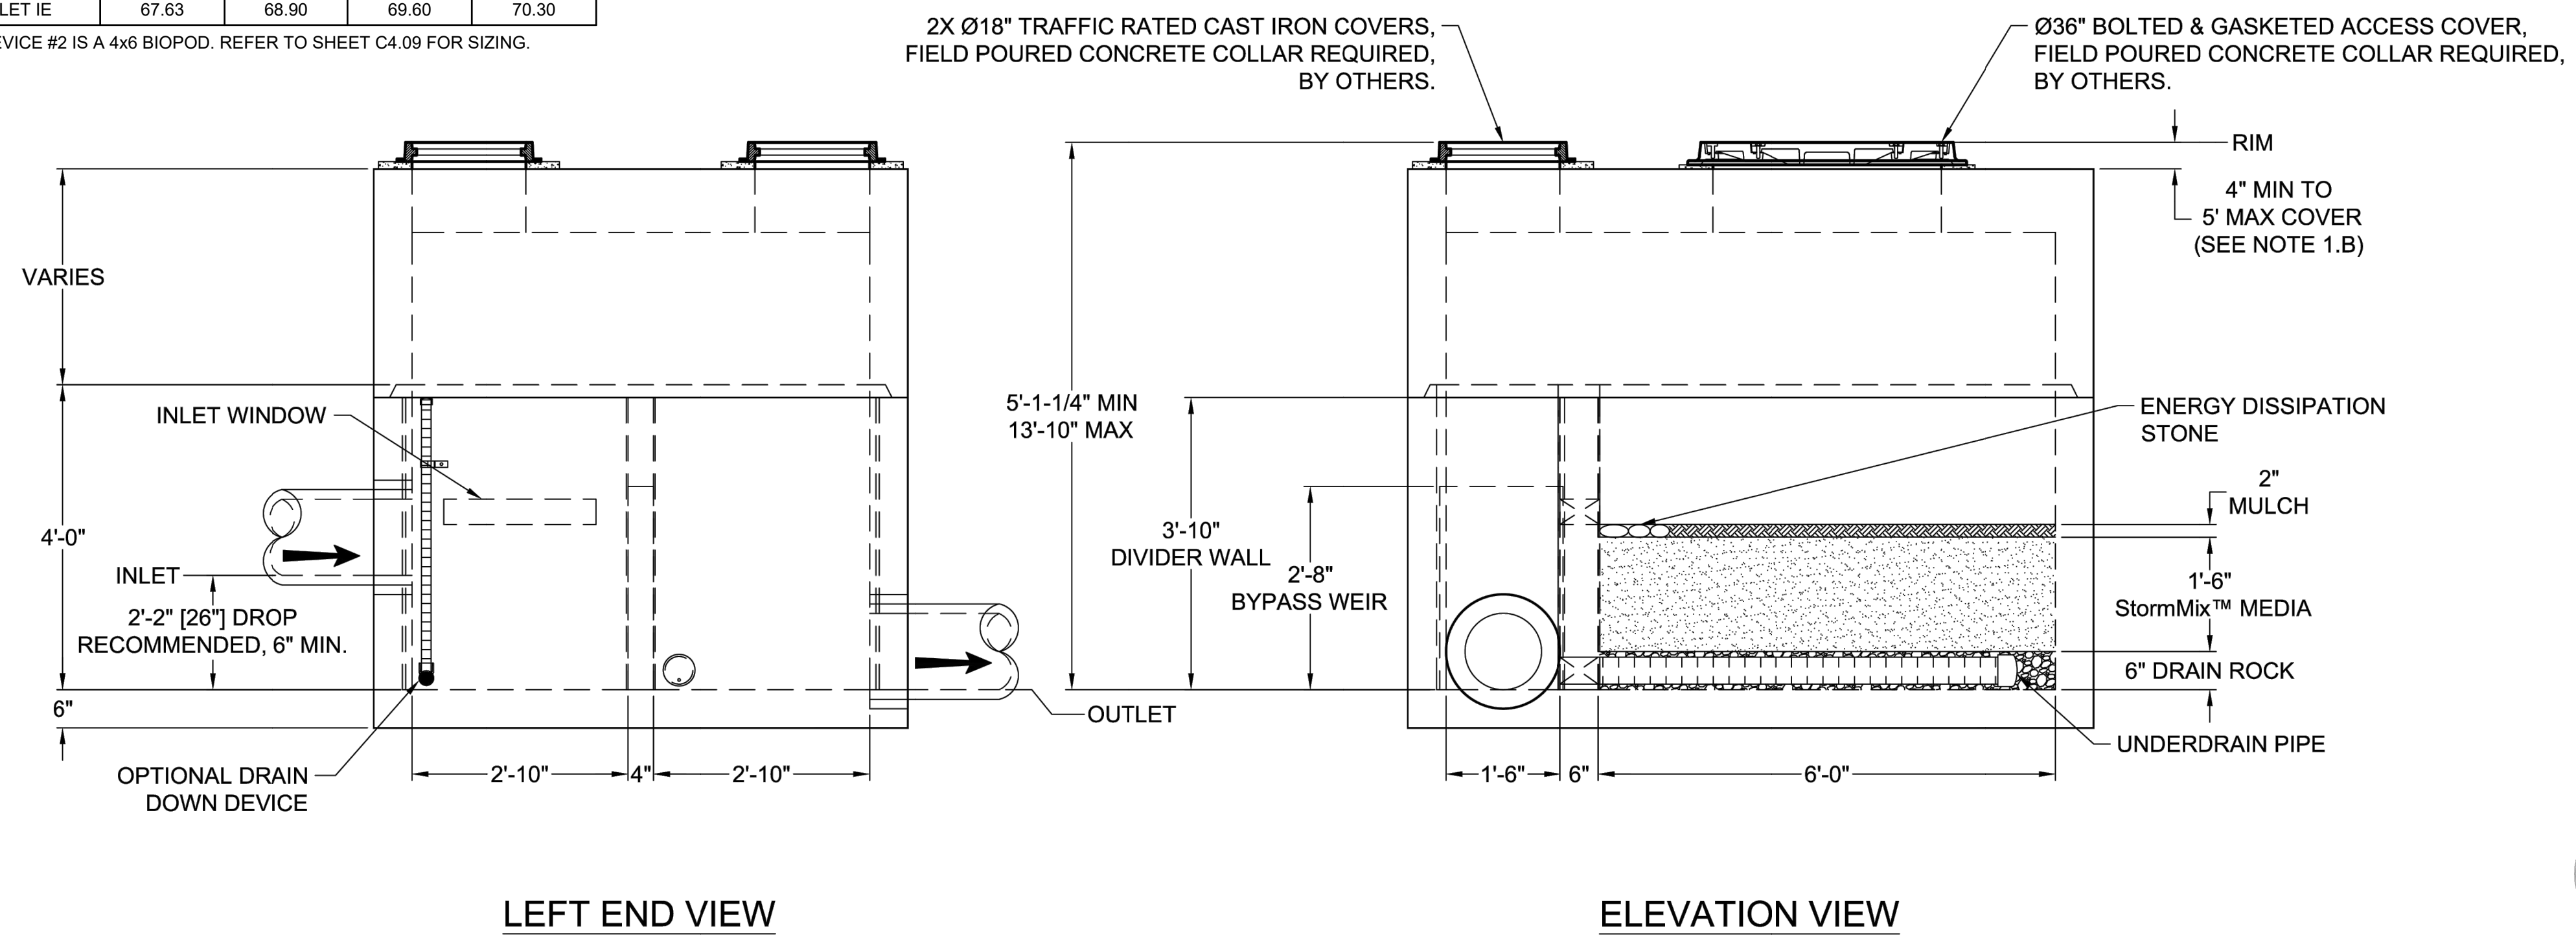

LEFT END VIEW

ELEVATION VIEW

- NOTES:**
- DESIGN LOADINGS:
    - AASHTO HS-20-44 (WITH IMPACT)
    - DESIGN SOIL COVER: 5'-0" MAXIMUM
    - ASSUMED WATER TABLE: BELOW BASE OF PRECAST (ENGINEER-OF-RECORD TO CONFIRM SITE WATER TABLE ELEVATION)
    - LATERAL EARTH PRESSURE: 45 PCF (DRAINED)
    - LATERAL LIVE LOAD SURCHARGE: 80 PSF (APPLIED TO 8'-0" BELOW GRADE)
    - NO LATERAL SURCHARGE FROM ADJACENT BUILDINGS, WALLS, PIERS, OR FOUNDATIONS.
  - CONCRETE 28-DAY MINIMUM COMPRESSIVE STRENGTH: 5,000 PSI MINIMUM.
  - REINFORCING: REBAR, ASTM A615/A706, GRADE 60
  - CEMENT: ASTM C150
  - REQUIRED ALLOWABLE SOIL BEARING CAPACITY: 2,500 PSF
  - REFERENCE STANDARD:
    - ASTM C890
    - ASTM C913
    - ACI 318-14
  - THIS STRUCTURE IS DESIGNED TO THE PARAMETERS NOTED HEREIN. ENGINEER-OF-RECORD SHALL VERIFY THAT NOTED PARAMETERS MEET OR EXCEED PROJECT REQUIREMENTS. IF DESIGN PARAMETERS ARE INCORRECT, REVIEWING ENGINEER/AUTHORITY SHALL NOTIFY OLDCASTLE INFRASTRUCTURE UPON REVIEW.
  - INLET AND OUTLET HOLES WILL BE FACTORY CORED/CAST PER PLANS AND CUSTOMER REQUIREMENTS. INLET AND OUTLET LOCATIONS CAN BE MIRRORRED.
  - CONTRACTOR RESPONSIBLE TO VERIFY ALL SIZES, LOCATIONS, AND ELEVATIONS OF OPENINGS.
  - CONTRACTOR RESPONSIBLE TO ENSURE ADEQUATE BEARING SURFACE IS PROVIDED (I.E. COMPACTED AND LEVEL PER PROJECT SPECIFICATIONS).
  - SECTION HEIGHTS, SLAB/WALL THICKNESSES, AND KEYWAYS ARE SUBJECT TO CHANGE AS REQUIRED FOR SITE REQUIREMENTS AND/OR DUE TO PRODUCT AVAILABILITY AND PRODUCTION FACILITY CONSTRAINTS.
  - MAXIMUM PICK WEIGHTS\*:
    - TOP: XX,XXX LBS
    - BASE: XX,XXX LBS\*
    - \* COMBINED WEIGHT OF BASE INCLUDES BYPASS WEIR, DIVIDER WALL, ROCK & MEDIA
  - INTERNALS SHALL CONSIST OF UNDERDRAIN PIPE, ROCK, STORMMIX™ MEDIA, MULCH, DIVIDER WALL, BYPASS WEIR AND OPTIONAL DRAIN DOWN.



Ph: 800.579.8819 | www.oldcastleinfrastructure.com/stormwater

THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE INFRASTRUCTURE, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE INFRASTRUCTURE, INC. COPYRIGHT © 2021 OLDCASTLE INFRASTRUCTURE, INC. ALL RIGHTS RESERVED.

BioPod™ Biofilter System (STANDARD)  
Underground Vault with Internal Bypass

CUSTOMER			
PROJECT NAME			
SHEET NAME	REVISION	REVISION	SHEET
Specifier Drawing			1 OF 1
BPU-681B	REV DATE		




Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
ASH DEVELOPMENT

GREG HELLE  
GREG.HELLE@ASHNW.COM

Project No.  
2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
04/09/2024

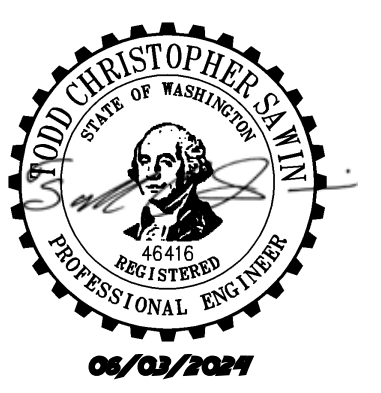

NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A REVIEW. CHECKING RIGHTS IN IT. NO GUARANTEE IS MADE ONLY FOR THE PROJECT DESCRIBED IN THE TITLE BLOCK AND NOT TO BE USED FOR OTHER PROJECTS OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

**City of Puyallup**  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title:  
**STORM DRAINAGE NOTES AND DETAILS**

Designed by: CW    Drawn by: SK / RS    Checked by: JI

Sheet No.  
**C4.08**  
22 of 53 Sheets



**1 6X8 BIOPOD**  
NOT TO SCALE



# EAST TOWN CROSSING PHASE 1


## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED

BY: *[Signature]*  
CITY OF PUYALLUP  
DEVELOPMENT ENGINEERING

DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

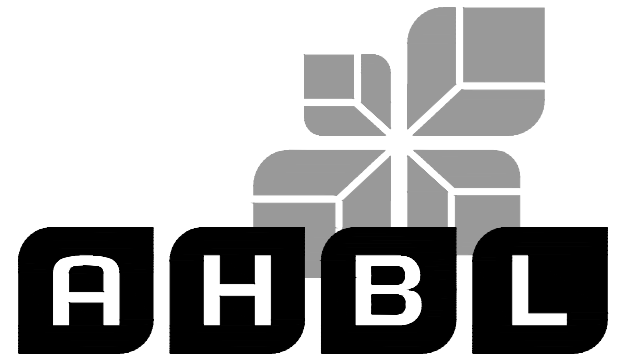

TACOMA · SEATTLE · SPOKANE · TRI-CITIES

2215 North 30th Street, Suite 300, Tacoma, WA 98403  
253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:


### EAST TOWN CROSSING PHASE 1

Client:  
ASH DEVELOPMENT

GREG HELLE  
GREG.HELLE@ASHNW.COM

Project No.  
2230752

Issue Set & Date:  
PERMIT SUBMITTAL  
04/09/2024

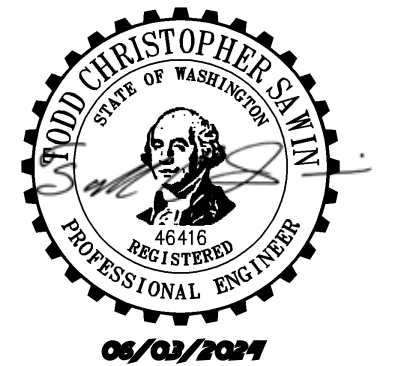

NOTICE  
ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A REVIEW BY THE ENGINEER. IT IS THE USER'S RESPONSIBILITY TO VERIFY THE ACCURACY OF THE INFORMATION PROVIDED IN THIS BLOCK AND TO BE USED FOR THE PROJECT, PERMITS, OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

**City of Puyallup**  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

### STORM DRAINAGE NOTES AND DETAILS


Designed by: CW    Drawn by: SK / RS    Checked by: JI

Sheet No.


## C4.09

23 of 53 Sheets


SITE SPECIFIC DATA				
Structure ID	ID			
Treatment Flow Rate (cfs)	0.05 CFS			
Peak Flow Rate (cfs)	1.2 CFS			
Rim Elevation	76.79			
Top of Vault Elevation	76.38			
Pipe Data	Pipe Location	Pipe Size	Pipe Type	Invert Elevation
Inlet	N	12"	CPEP	71.37
Outlet	S	12"	CPEP	69.20
Notes:				
PERFORMANCE SPECIFICATIONS				
Treatment Flow Capacities:*				
NJDEP 80% Removal, 75 micron	0.064 cfs			
WA Ecology GULD - Basic, Enhanced & Phosphorus	0.057 cfs			
Bypass Capacity	5.0 cfs			
<small>*Contact Oldcastle for alternative treatment flow capacities.</small>				

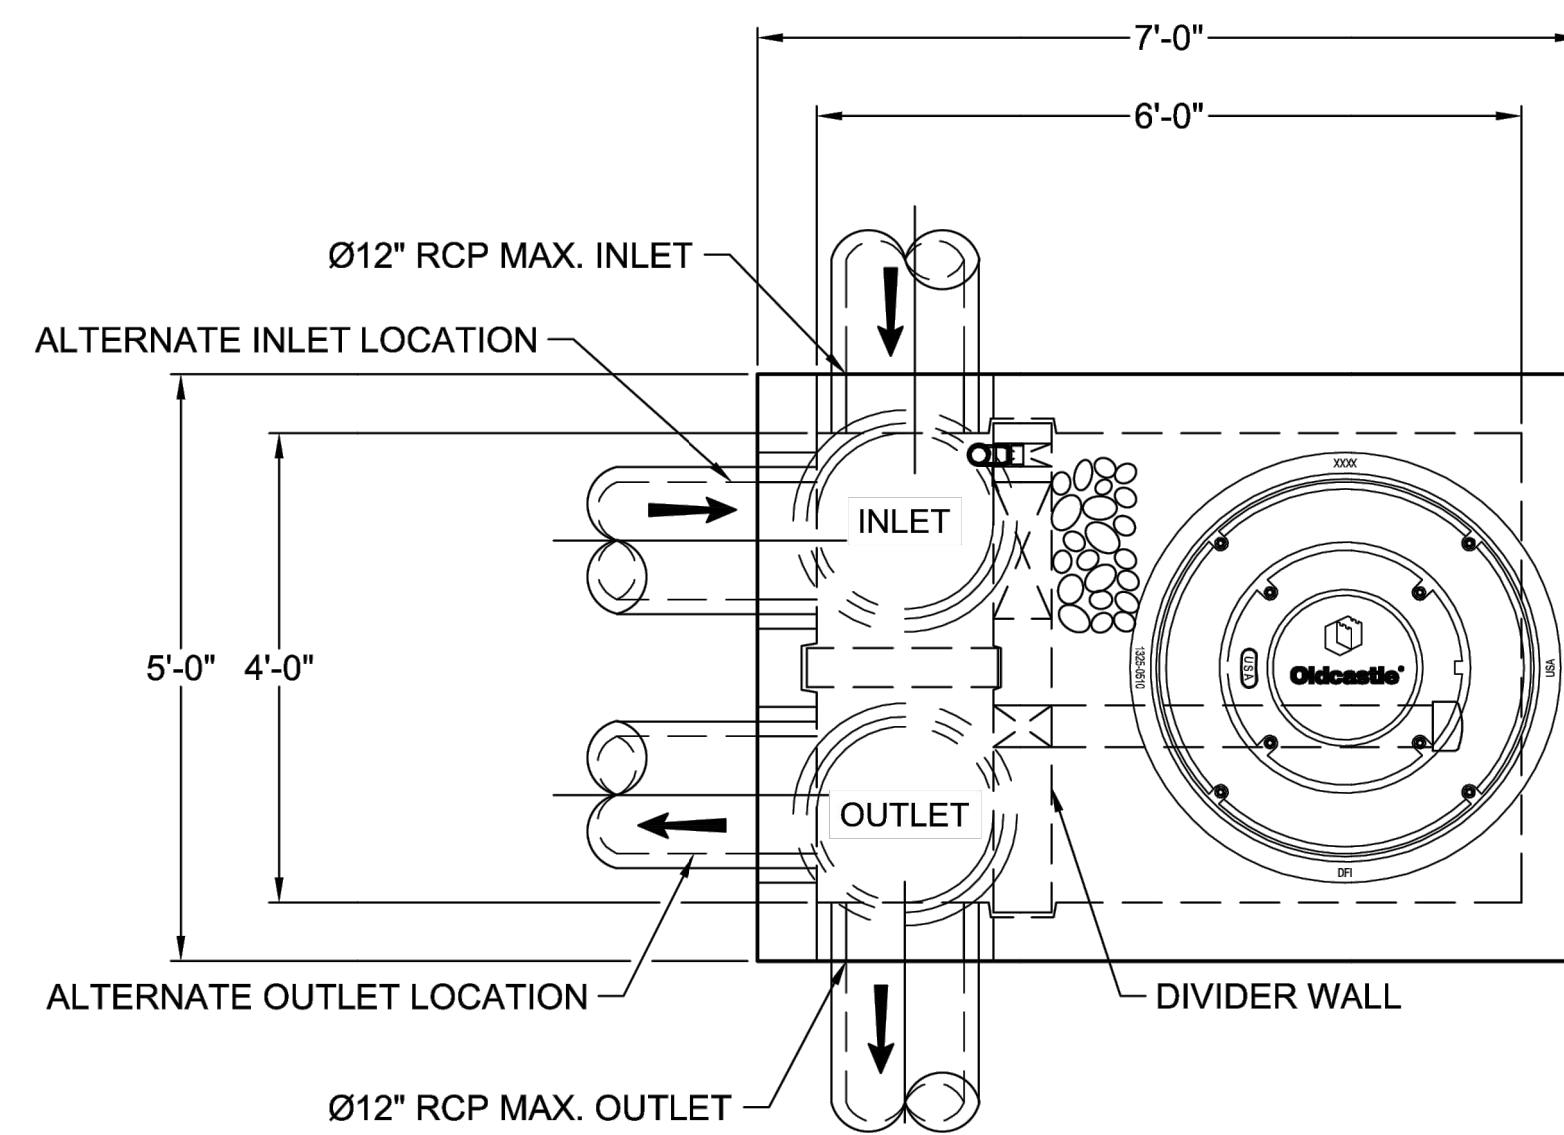

PLAN VIEW

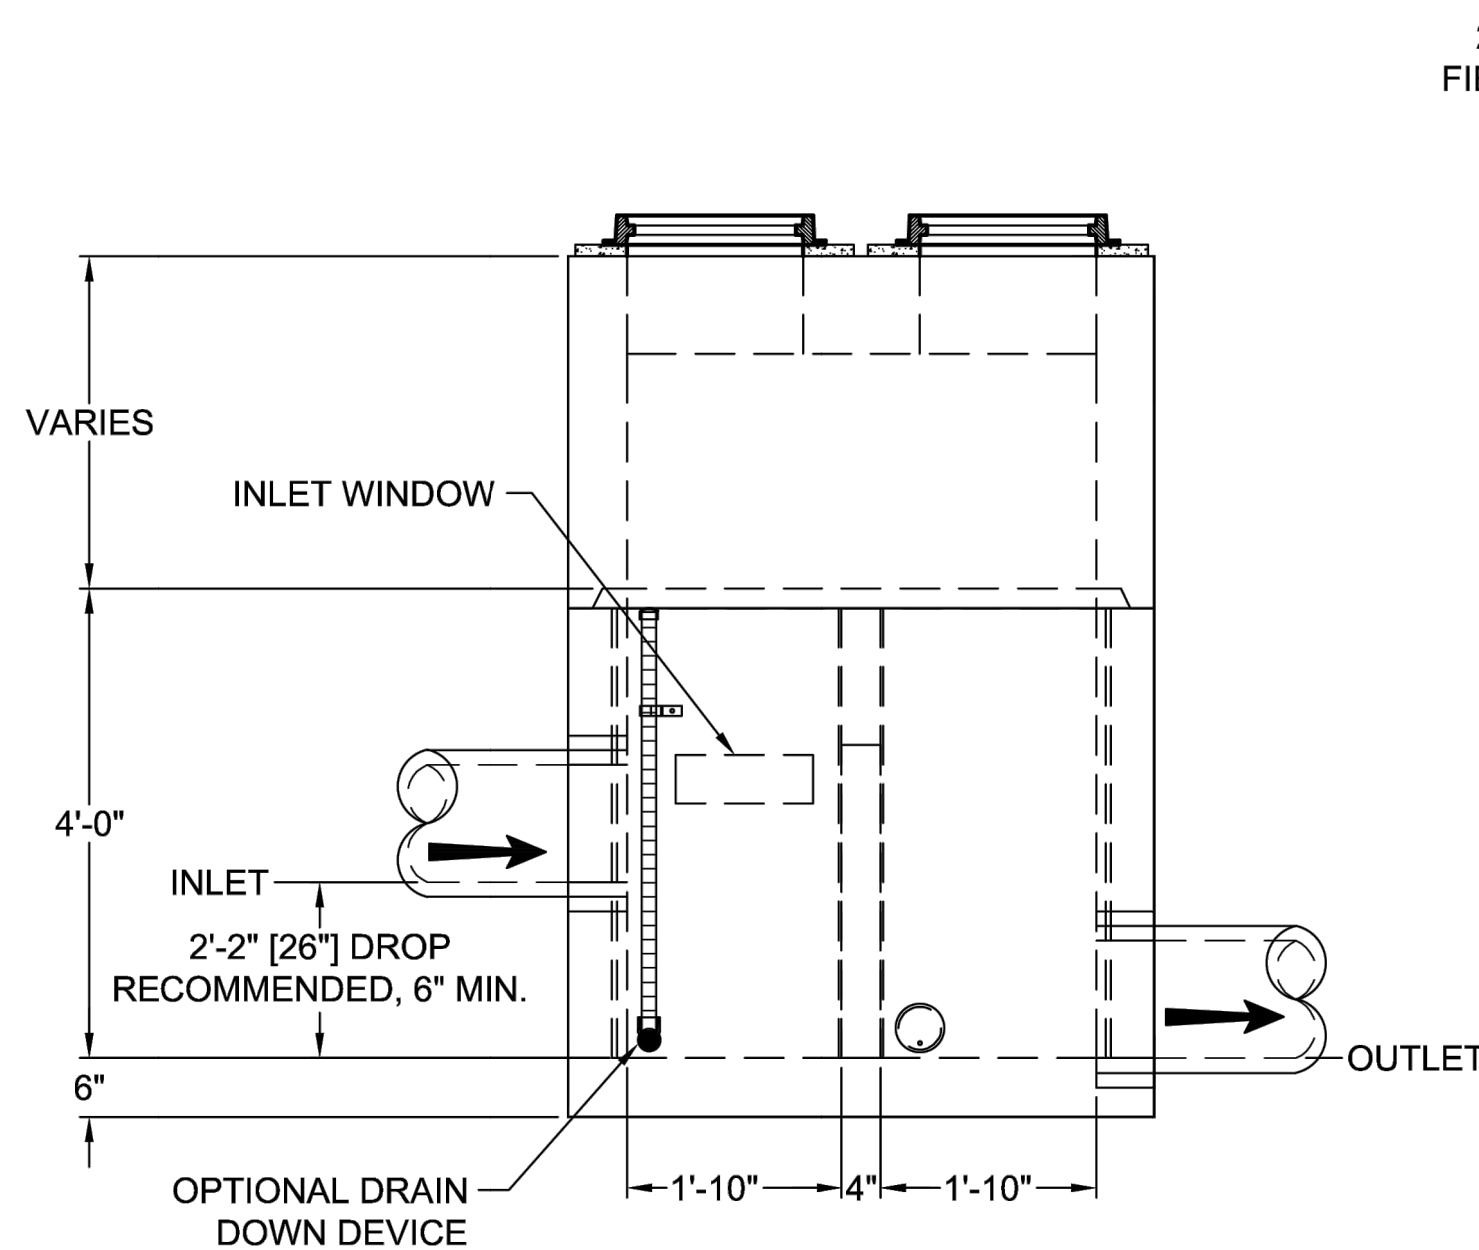

LEFT END VIEW

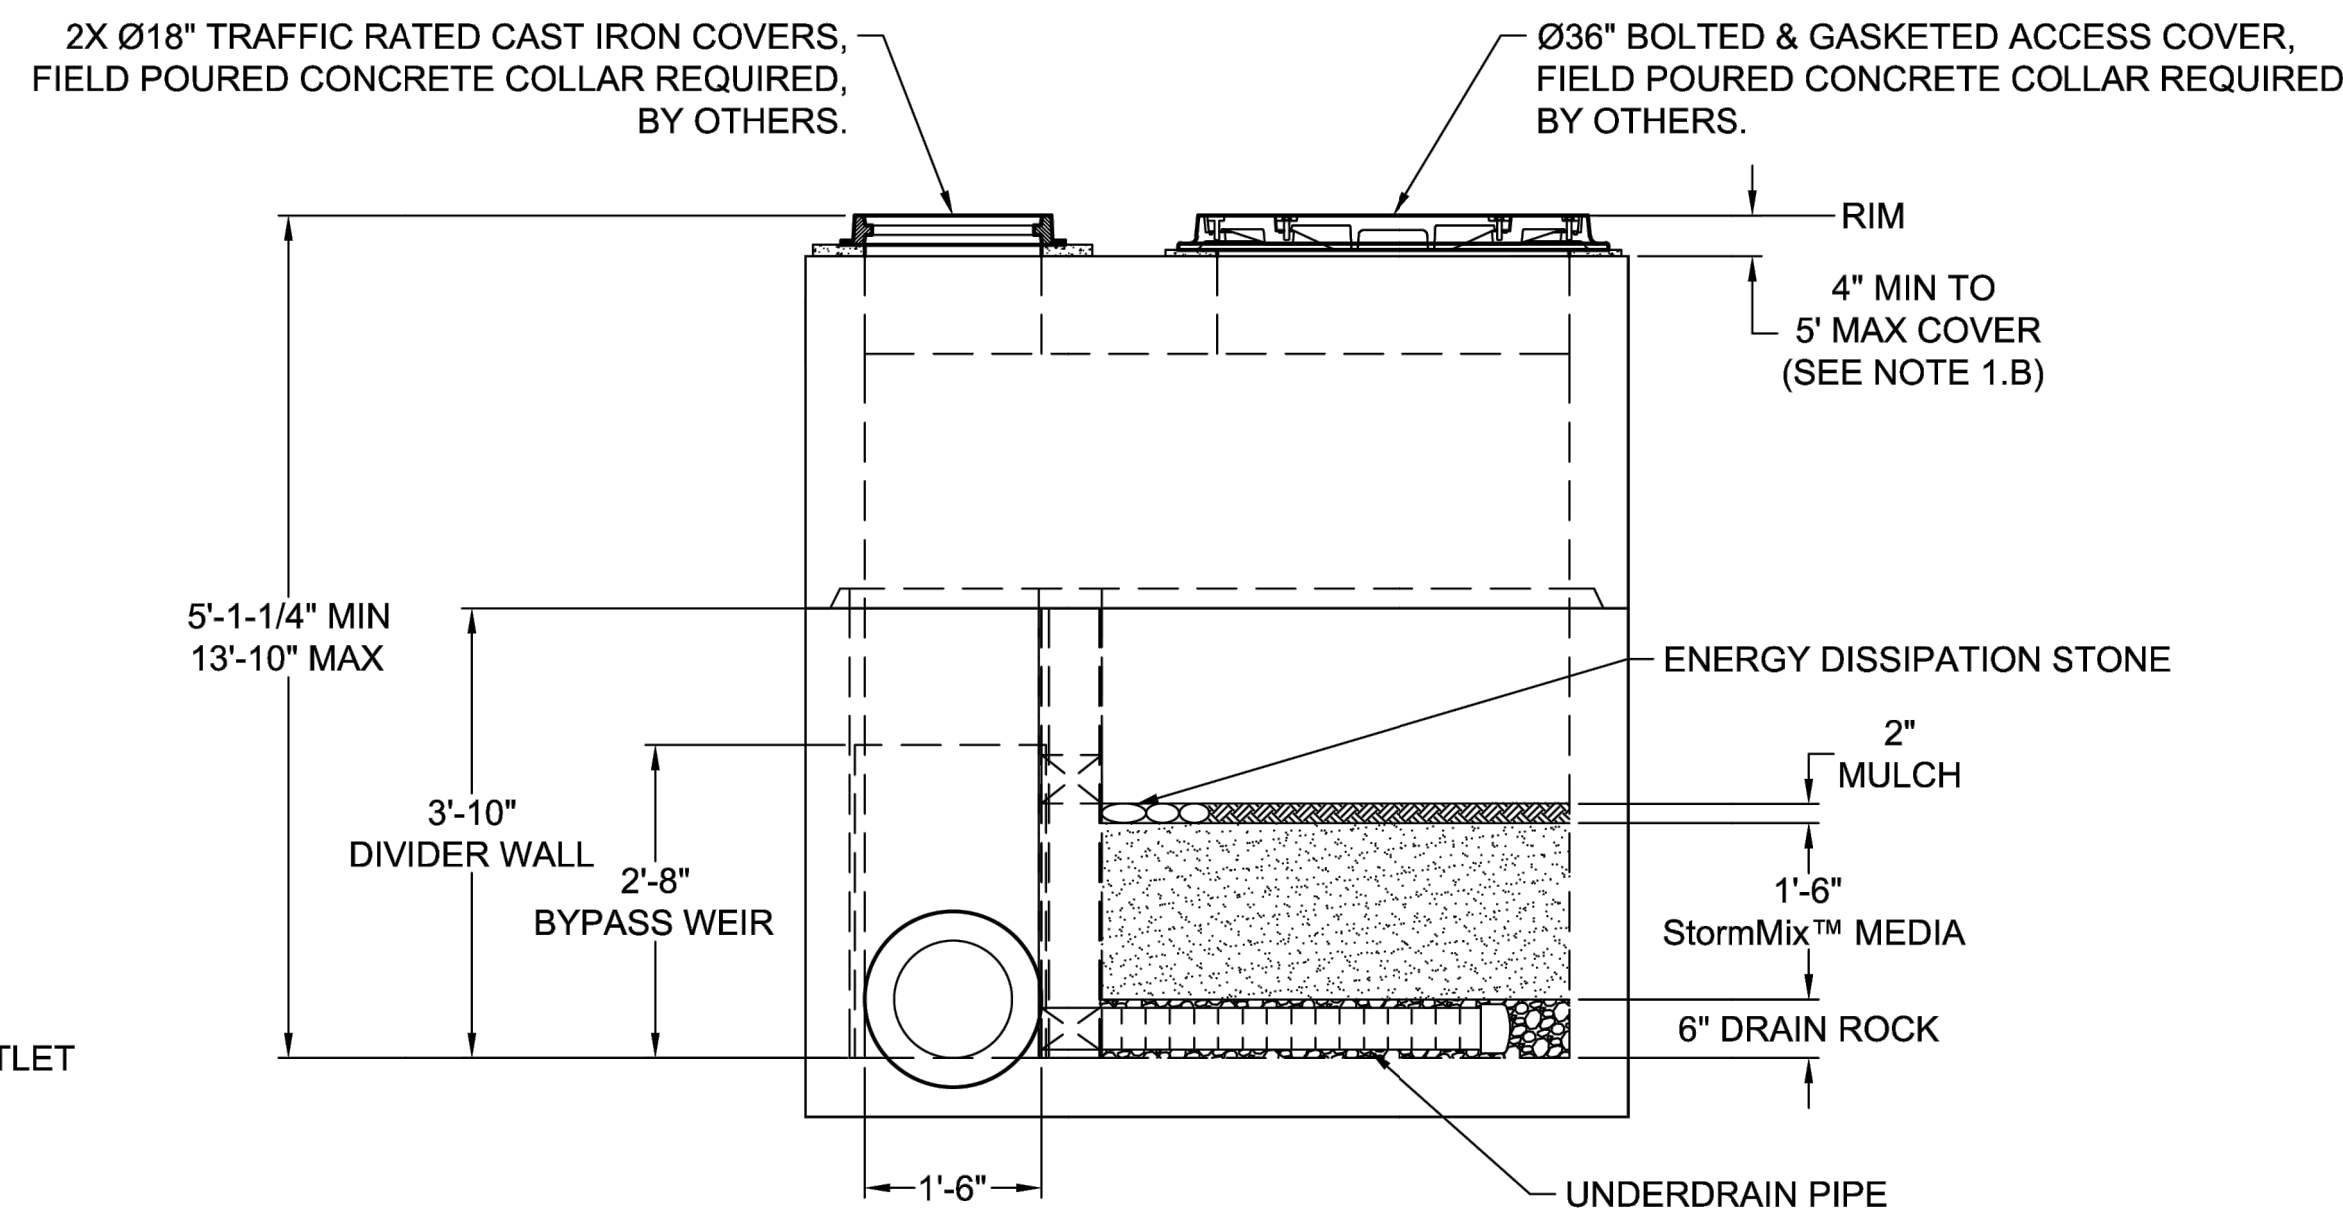

ELEVATION VIEW


**NOTES:**

1. DESIGN LOADINGS:
  - A. AASHTO HS-20-44 (WITH IMPACT)
  - B. DESIGN SOIL COVER: 5'-0" MAXIMUM
  - C. ASSUMED WATER TABLE: BELOW BASE OF PRECAST (ENGINEER-OF-RECORD TO CONFIRM SITE WATER TABLE ELEVATION)
  - D. LATERAL EARTH PRESSURE: 45 PCF (DRAINED)
  - E. LATERAL LIVE LOAD SURCHARGE: 80 PSF (APPLIED TO 8'-0" BELOW GRADE)
  - F. NO LATERAL SURCHARGE FROM ADJACENT BUILDINGS, WALLS, PIERS, OR FOUNDATIONS.
2. CONCRETE 28-DAY MINIMUM COMPRESSIVE STRENGTH: 5,000 PSI MINIMUM.
3. REINFORCING: REBAR, ASTM A615/A706, GRADE 60
4. CEMENT: ASTM C150
5. REQUIRED ALLOWABLE SOIL BEARING CAPACITY: 2,500 PSF
6. REFERENCE STANDARD:
  - A. ASTM C890
  - B. ASTM C913
  - C. ACI 318-14
7. THIS STRUCTURE IS DESIGNED TO THE PARAMETERS NOTED HEREIN. ENGINEER-OF-RECORD SHALL VERIFY THAT NOTED PARAMETERS MEET OR EXCEED PROJECT REQUIREMENTS. IF DESIGN PARAMETERS ARE INCORRECT, REVIEWING ENGINEER/AUTHORITY SHALL NOTIFY OLDCASTLE INFRASTRUCTURE UPON REVIEW.
8. INLET AND OUTLET HOLES WILL BE FACTORY CORED/CAST PER PLANS AND CUSTOMER REQUIREMENTS. INLET AND OUTLET LOCATIONS CAN BE MIRRORED.
9. CONTRACTOR RESPONSIBLE TO VERIFY ALL SIZES, LOCATIONS, AND ELEVATIONS OF OPENINGS.
10. CONTRACTOR RESPONSIBLE TO ENSURE ADEQUATE BEARING SURFACE IS PROVIDED (I.E. COMPACTED AND LEVEL PER PROJECT SPECIFICATIONS).
11. SECTION HEIGHTS, SLAB/WALL THICKNESSES, AND KEYWAYS ARE SUBJECT TO CHANGE AS REQUIRED FOR SITE REQUIREMENTS AND/OR DUE TO PRODUCT AVAILABILITY AND PRODUCTION FACILITY CONSTRAINTS.
12. MAXIMUM PICK WEIGHTS\*:
  - A. TOP: XX,XXX LBS
  - B. BASE: XX,XXX LBS\*
  - (\* COMBINED WEIGHT OF BASE INCLUDES BYPASS WEIR, DIVIDER WALL, ROCK & MEDIA)
13. INTERNALS SHALL CONSIST OF UNDERDRAIN PIPE, ROCK, STORMMIX™ MEDIA, MULCH, DIVIDER WALL, BYPASS WEIR AND OPTIONAL DRAIN DOWN.



Ph: 800.579.8819 | www.oldcastleinfrastructure.com/stormwater  
THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE INFRASTRUCTURE, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE INFRASTRUCTURE, INC. COPYRIGHT © 2021 OLDCASTLE INFRASTRUCTURE, INC. ALL RIGHTS RESERVED.

BioPod™ Biofilter System (STANDARD)			
Underground Vault with Internal Bypass			
CUSTOMER	-		
PROJECT NAME	-		
SHEET NAME	REVISION	REV DATE	SHEET
Specifier Drawing	-	-	1 OF 1
BPU-461B	-	-	



Know what's below.  
Call before you dig.

1 **4X6 BIPOD**  
NOT TO SCALE



# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.  
 THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.  
 FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.



TACOMA • SEATTLE • SPOKANE • TRI-CITIES

2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

Client Contact:  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
 PERMIT SUBMITTAL  
 05/17/2024



NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OR WARRANTY BY THE ENGINEER OR DESIGNER. THE ENGINEER OR DESIGNER IS NOT TO BE HELD RESPONSIBLE FOR ANY ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS



01/29/24 CITY COMMENTS

Revisions:

Sheet Title:  
**R-TANK 1 NOTES AND DETAILS**

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C4.10**  
 24 of 53 Sheets

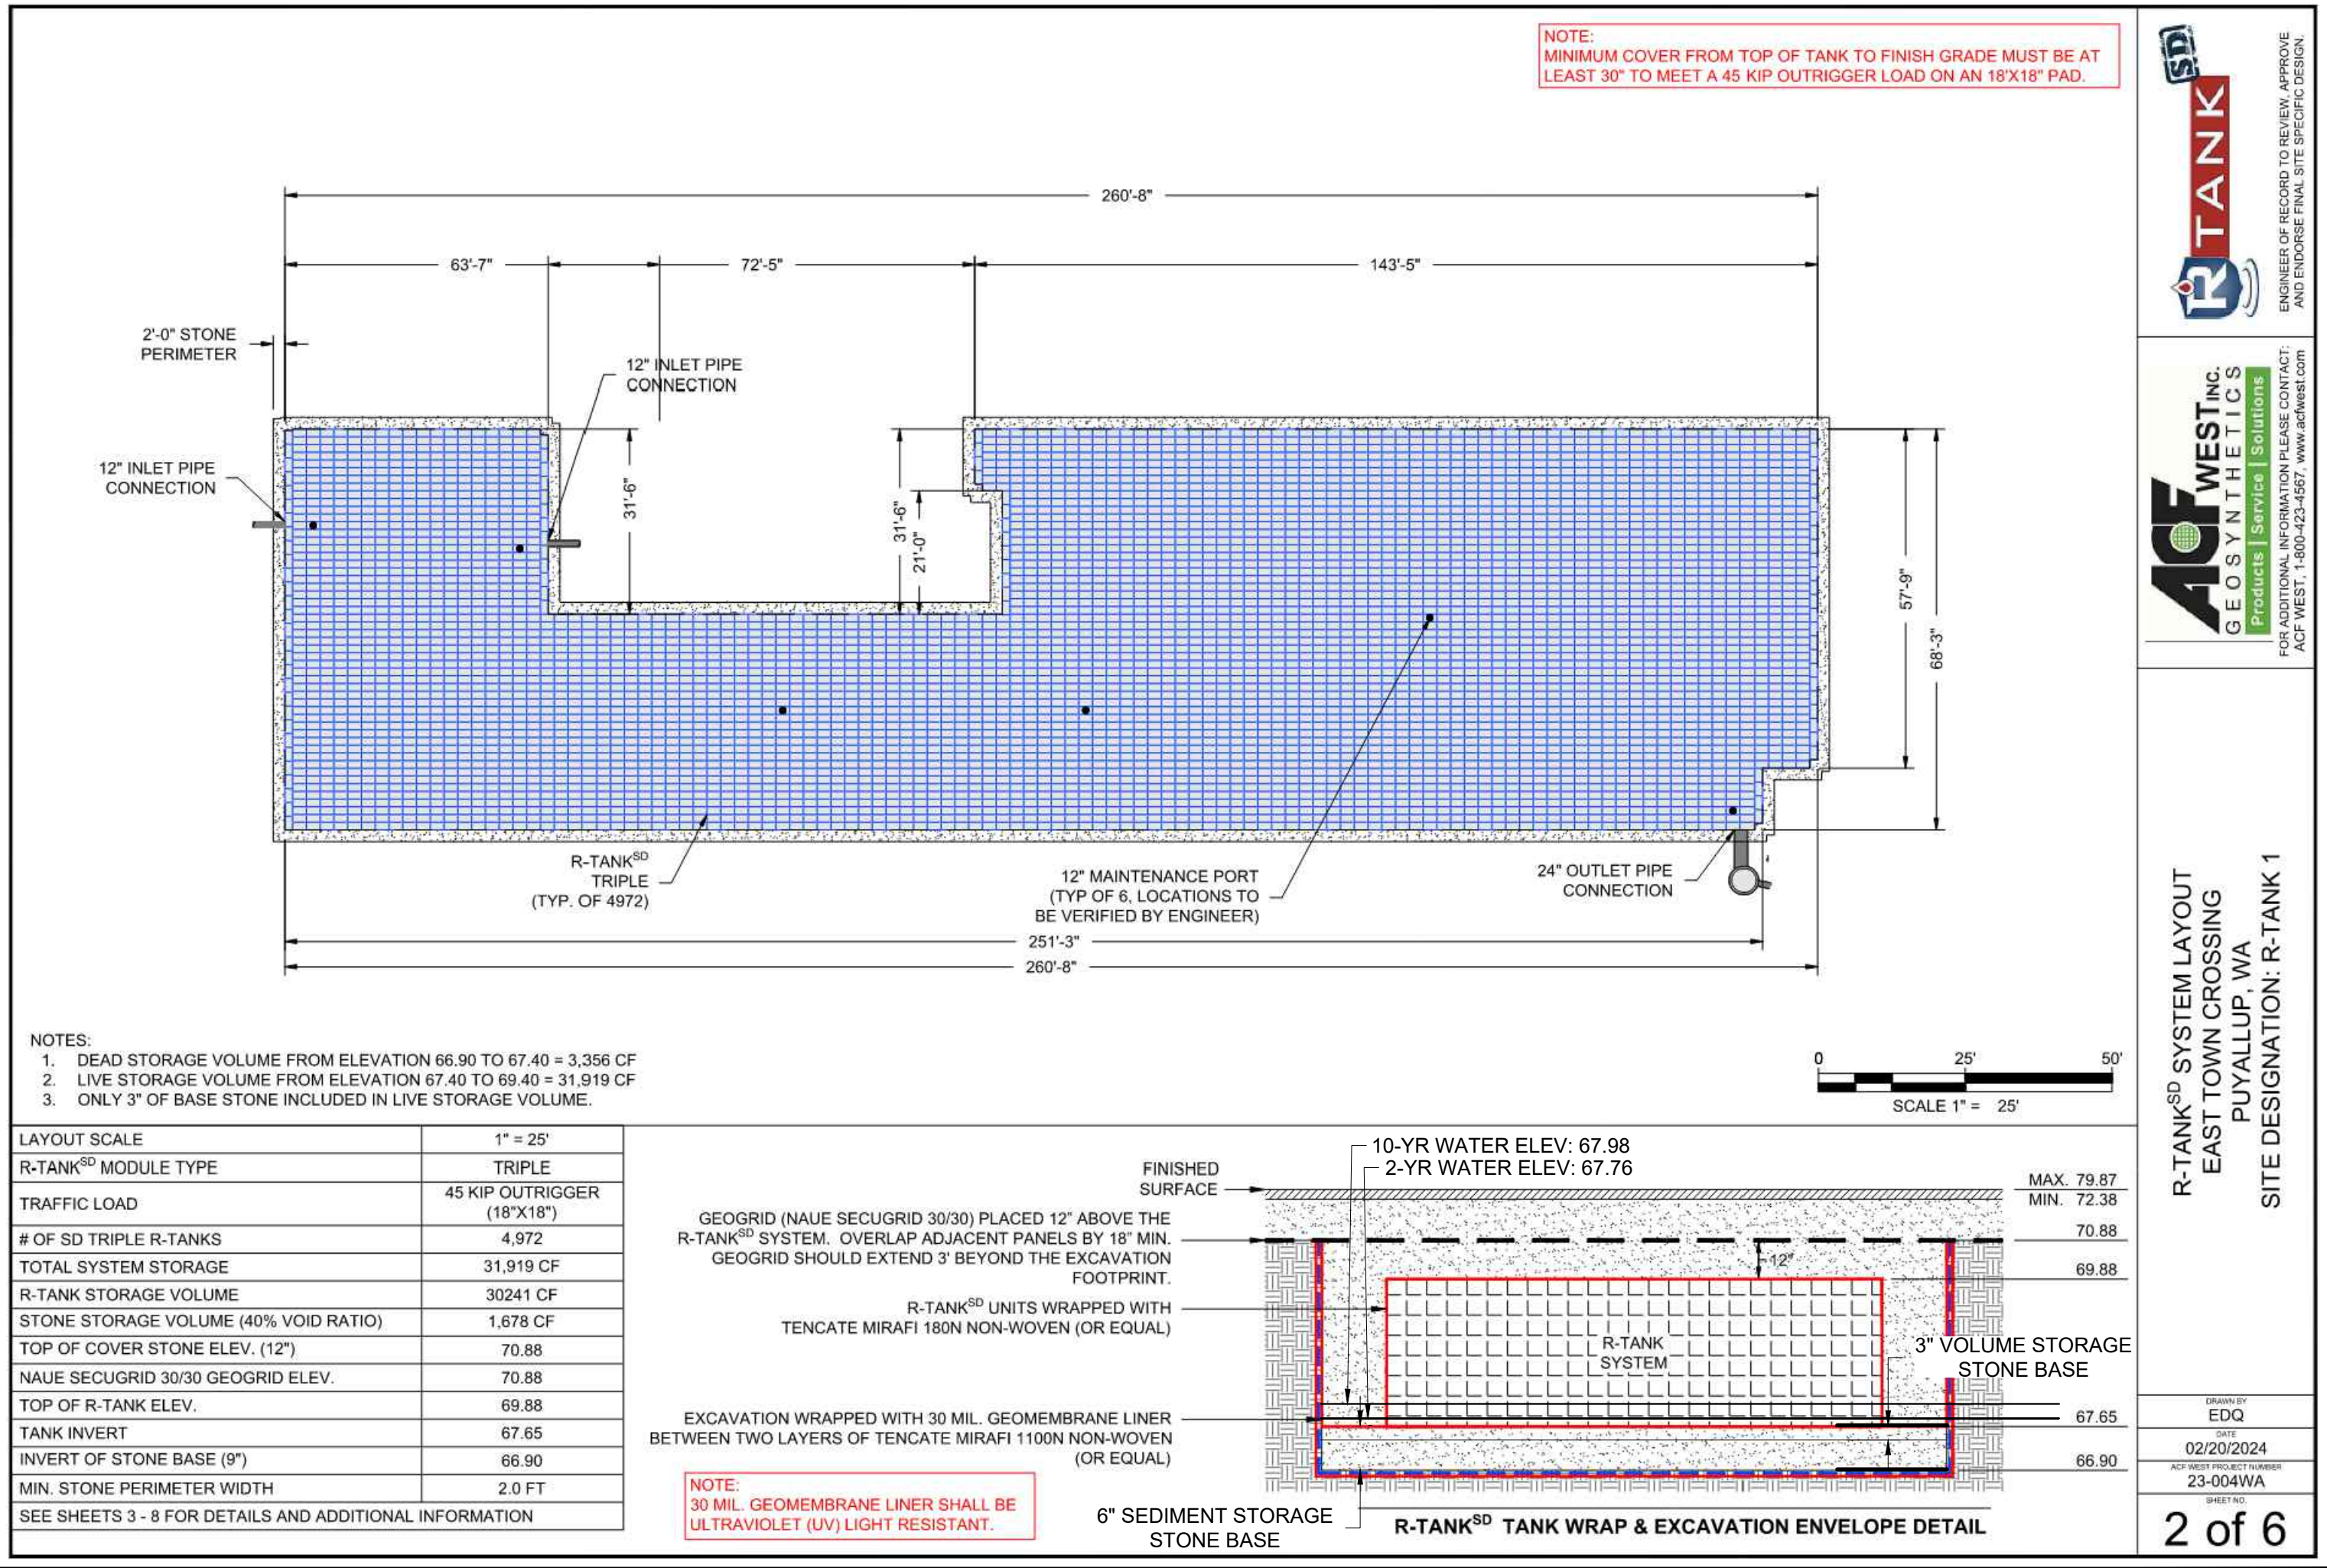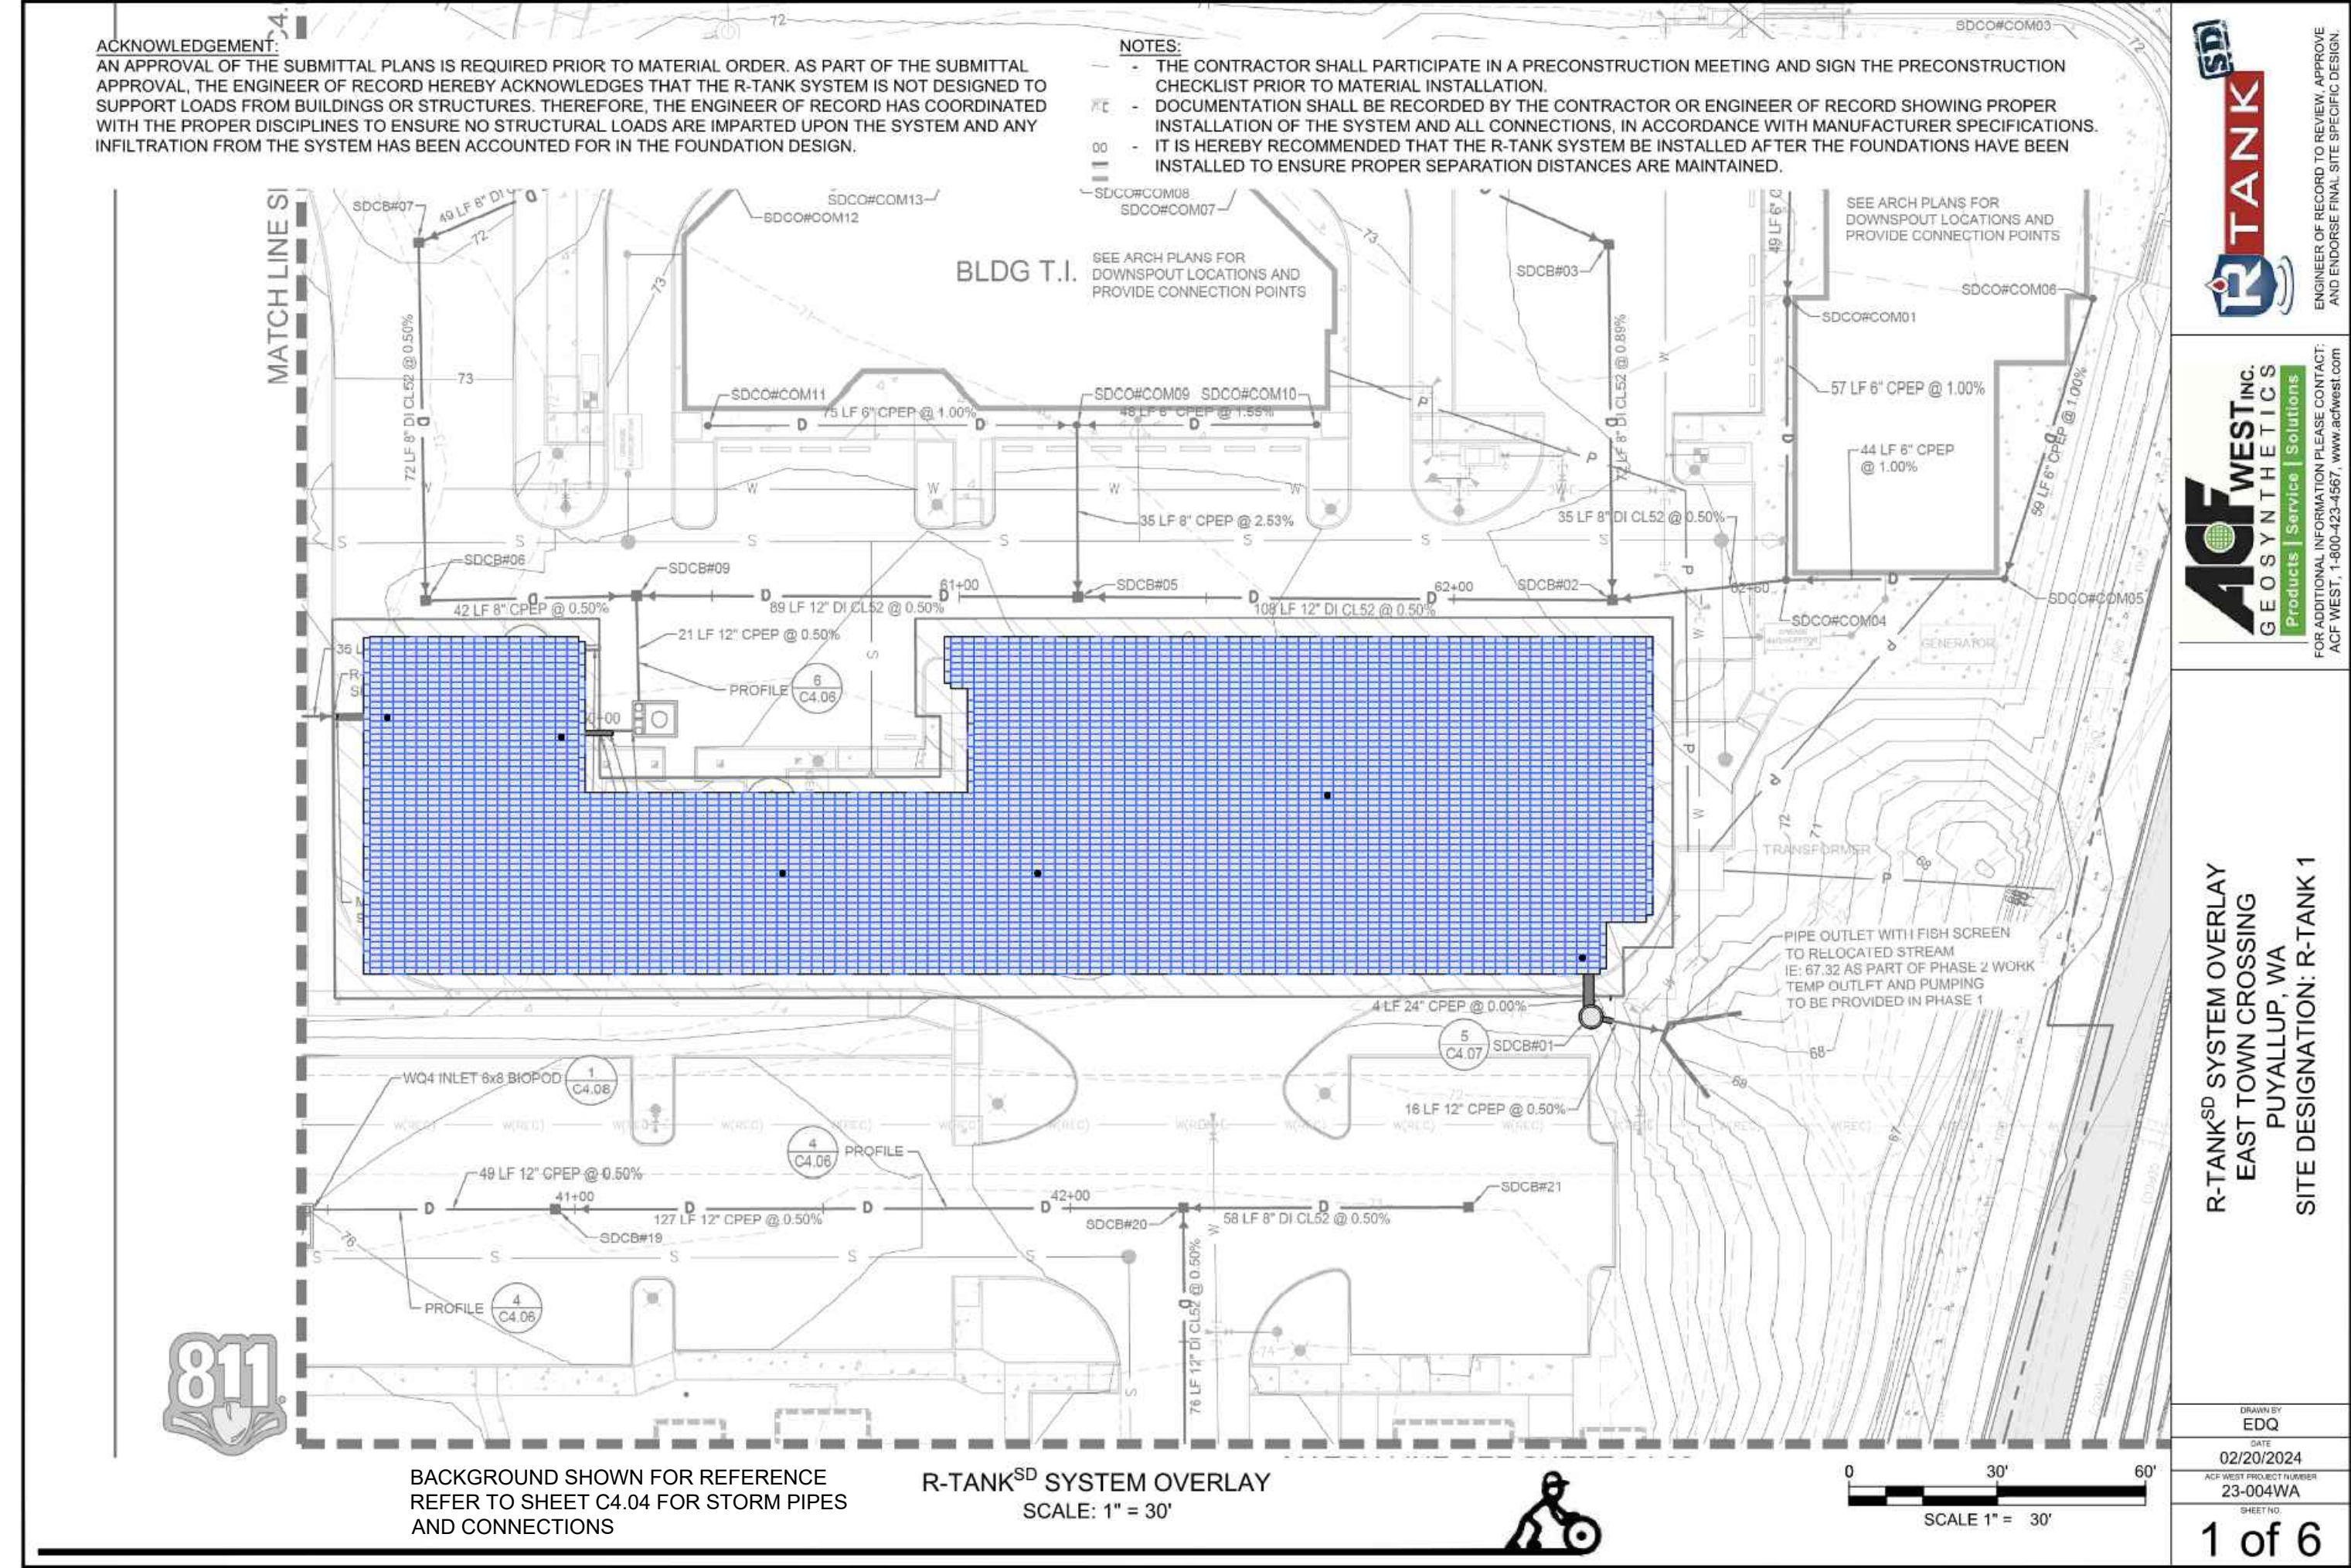

**811**  
 Know what's below.  
 Call before you dig.



# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.




Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024

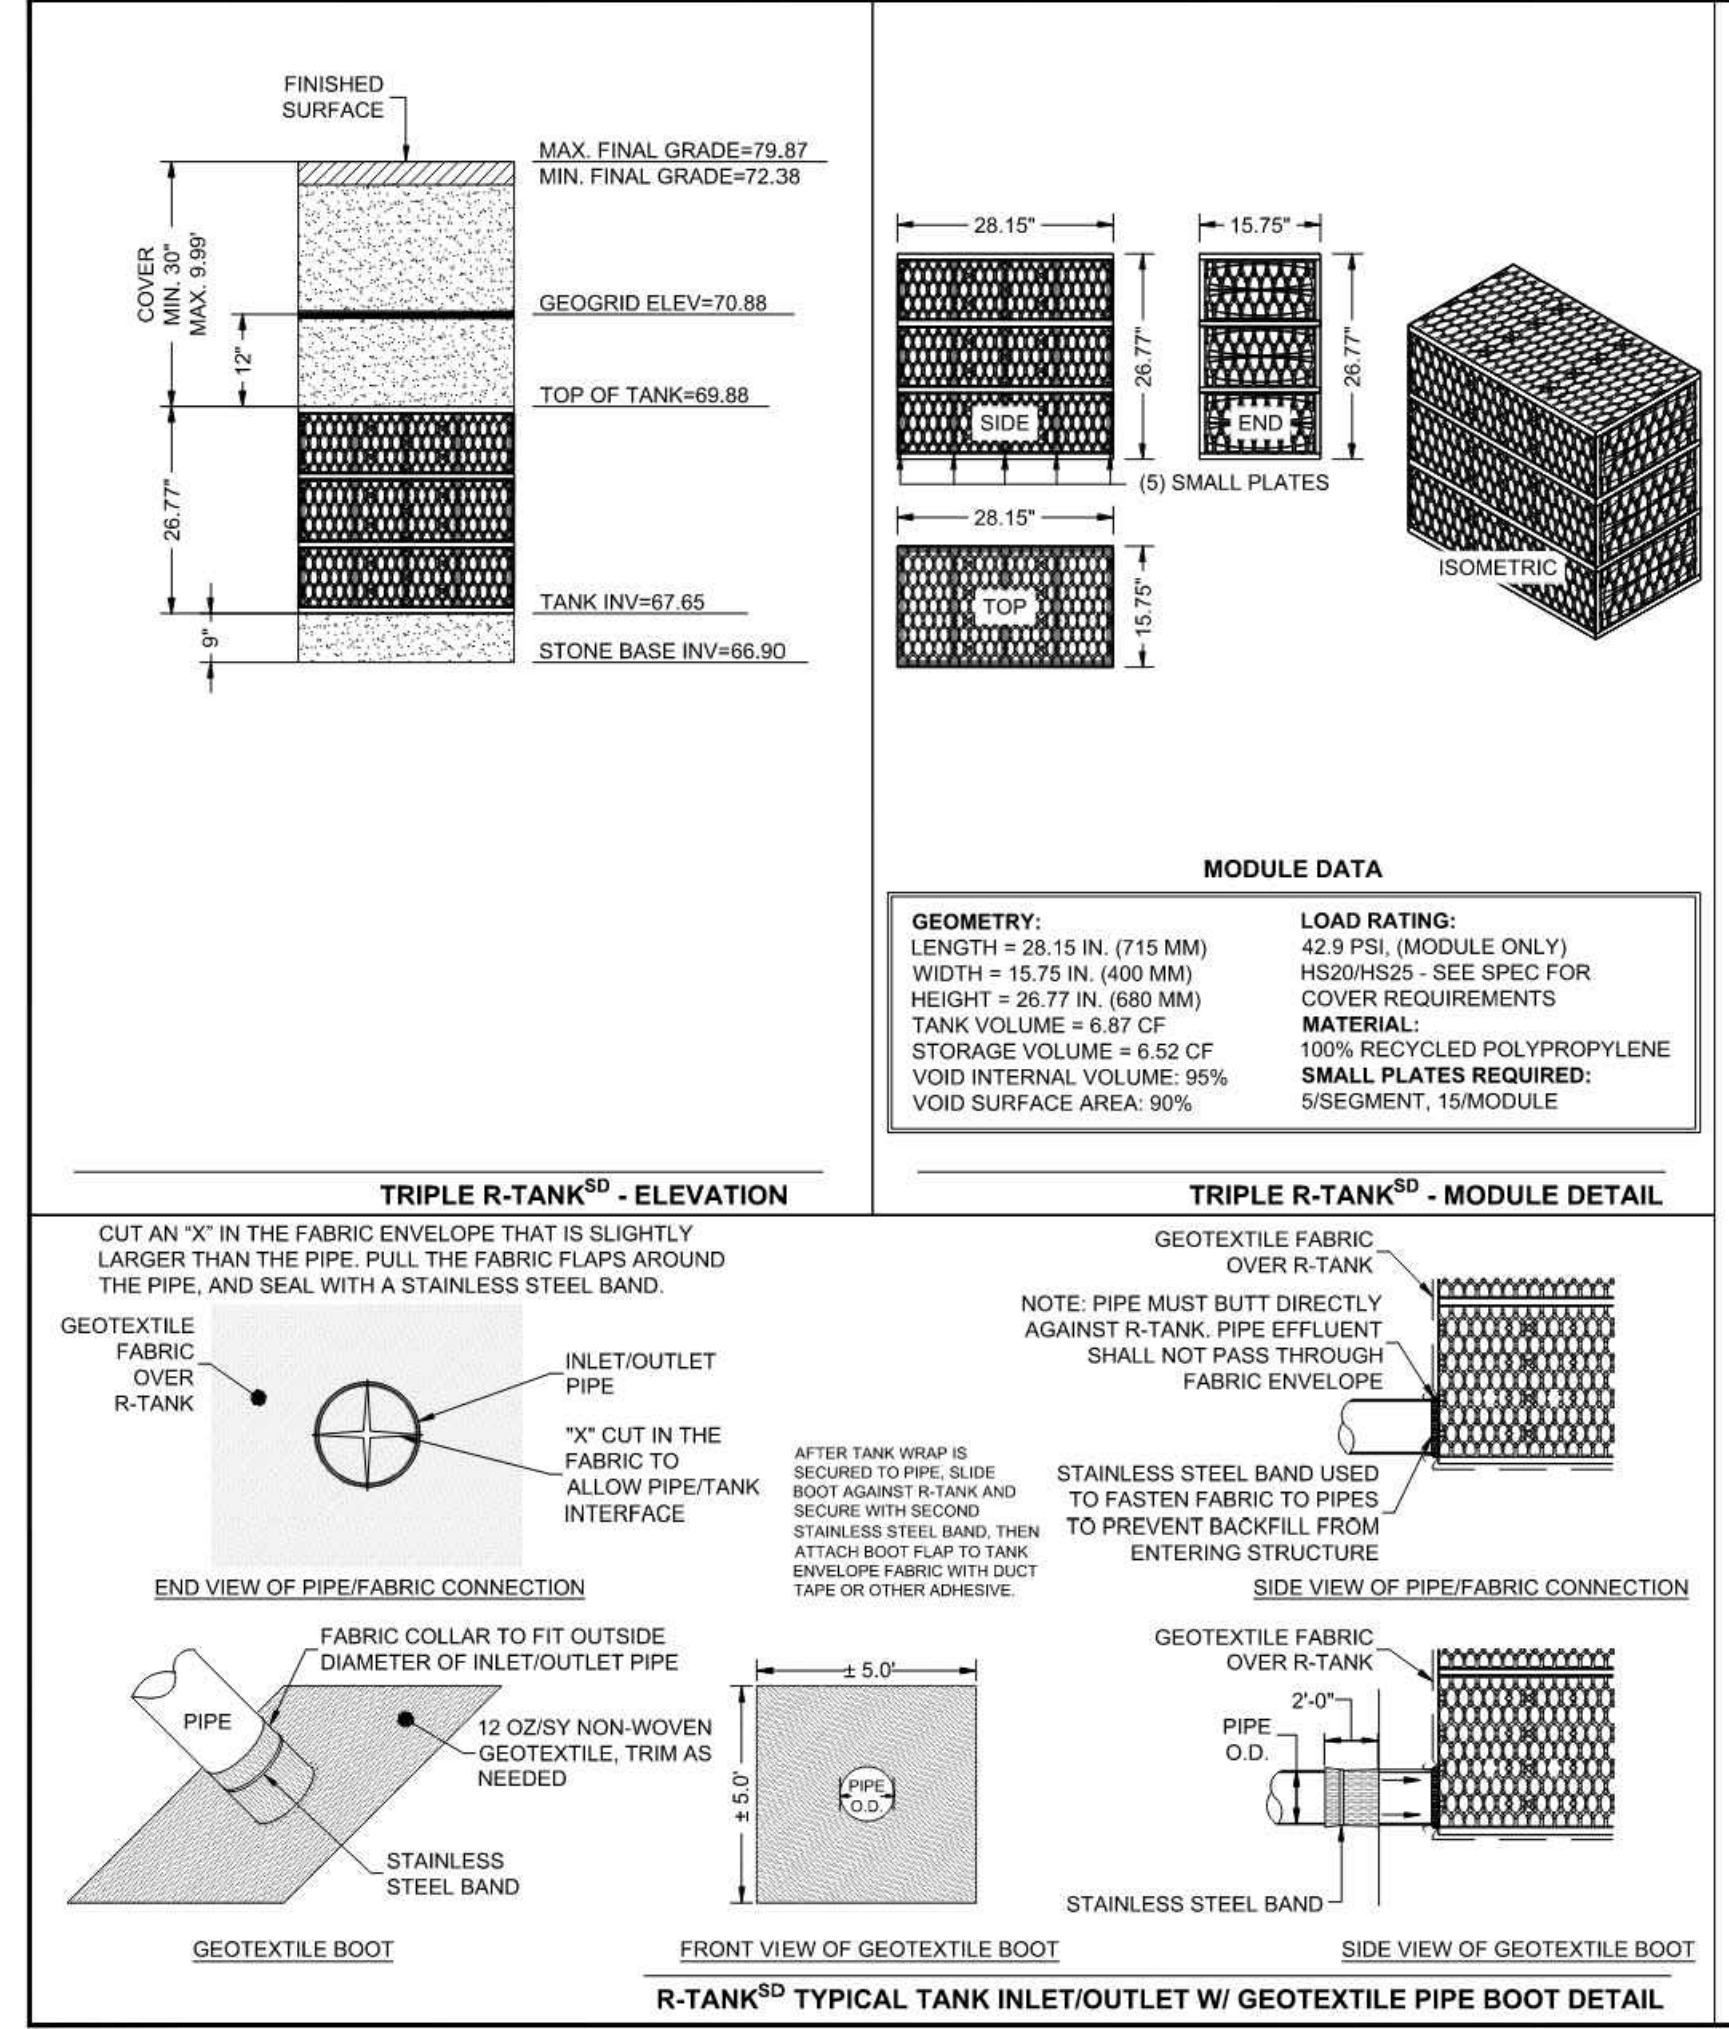




R-TANK <sup>SD</sup> QUANTITIES	
R-TANK <sup>SD</sup> MODULE TYPE	TRIPLE
# OF SD TRIPLE R-TANKS	4,972
TOTAL SYSTEM STORAGE	31919
R-TANK STORAGE VOLUME	30241
STONE STORAGE VOLUME (40% VOID RATIO)	1678
STONE BED FOOTPRINT	1,209 CY
TENCATE MIRAFI 160N NON-WOVEN TANK WRAP	37,082 SF (4,120 SY)
30 MIL. GEOMEMBRANE LINER EXCAVATION WRAP	22,713 SF (2,524 SY)
TENCATE MIRAFI 1100N NON-WOVEN LINER PROTECTION	45,427 SF (5,047 SY)
NAUE SECUGRID 30/30 GEOGRID	20,162 SF (2,240 SY)
12" MAINTENANCE PORTS	6
12" PIPE BOOTS	2
24" PIPE BOOTS	1
TRASHGUARD PLUS UNITS (RECOMMENDED)	2

NOTE: STONE QUANTITY INCLUDES 12" OF COVER AND 9" OF BASE.  
 NOTE: GEOTEXTILE / LINER QUANTITIES INCLUDE A 15% WASTE FACTOR.

NOTE:  
 30 MIL. GEOMEMBRANE LINER SHALL BE ULTRAVIOLET (UV) LIGHT RESISTANT.

NOTES:  
 1. DEAD STORAGE VOLUME FROM ELEVATION 66.90 TO 67.40 = 3,356 CF  
 2. LIVE STORAGE VOLUME FROM ELEVATION 67.40 TO 69.40 = 31,919 CF  
 3. ONLY 3" OF BASE STONE INCLUDED IN LIVE STORAGE VOLUME.

**R-TANK<sup>SD</sup> SYSTEM DETAILS**  
 EAST TOWN CROSSING  
 PUYALLUP, WA  
 SITE DESIGNATION: R-TANK 1  
 3 of 6

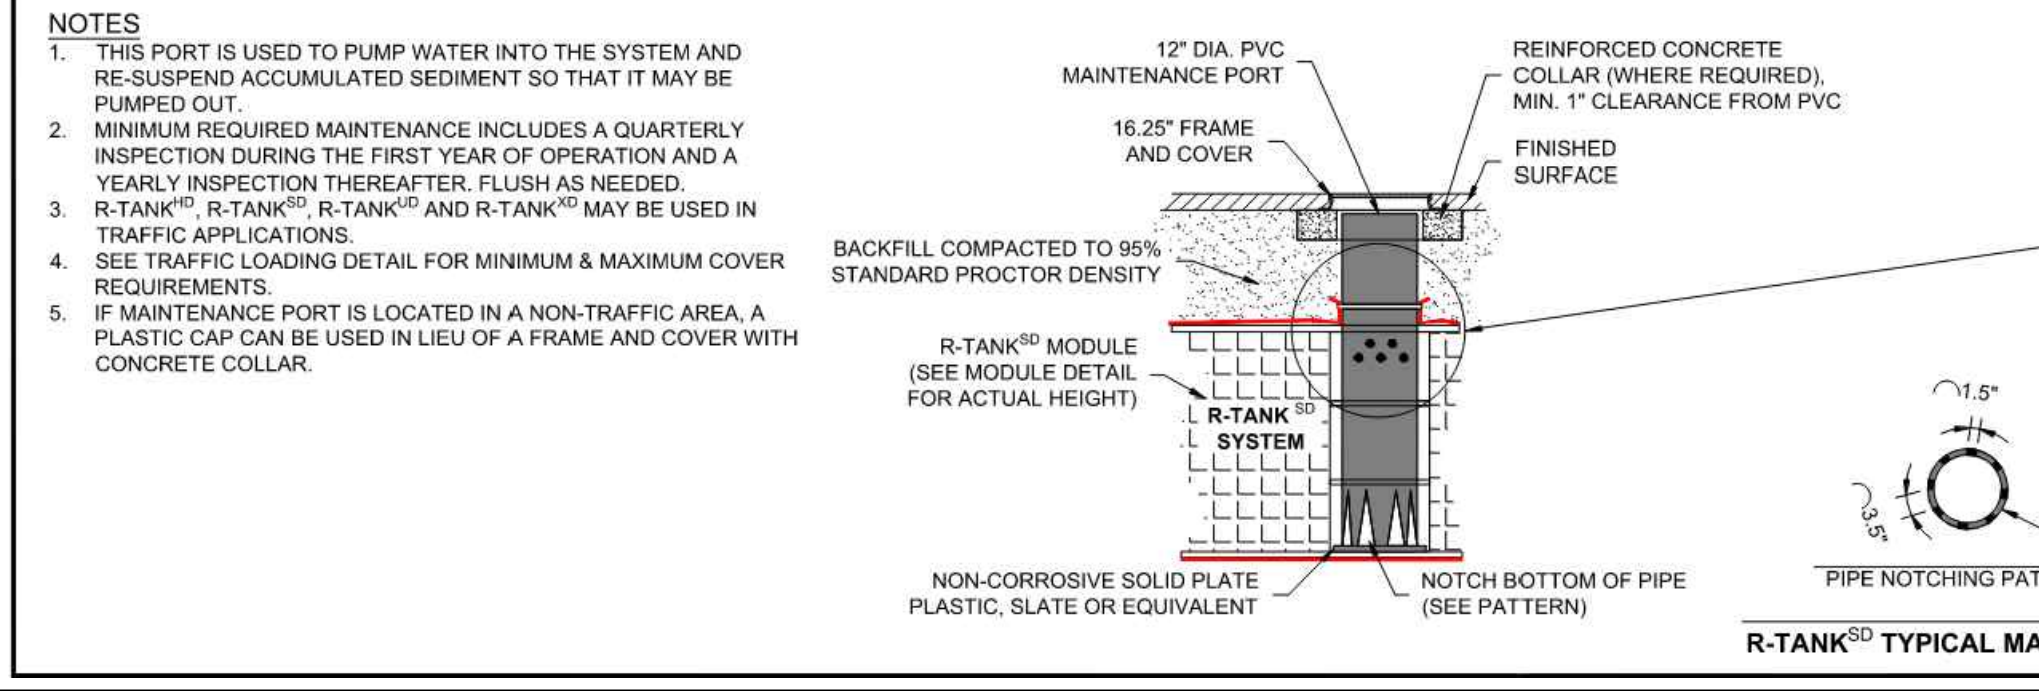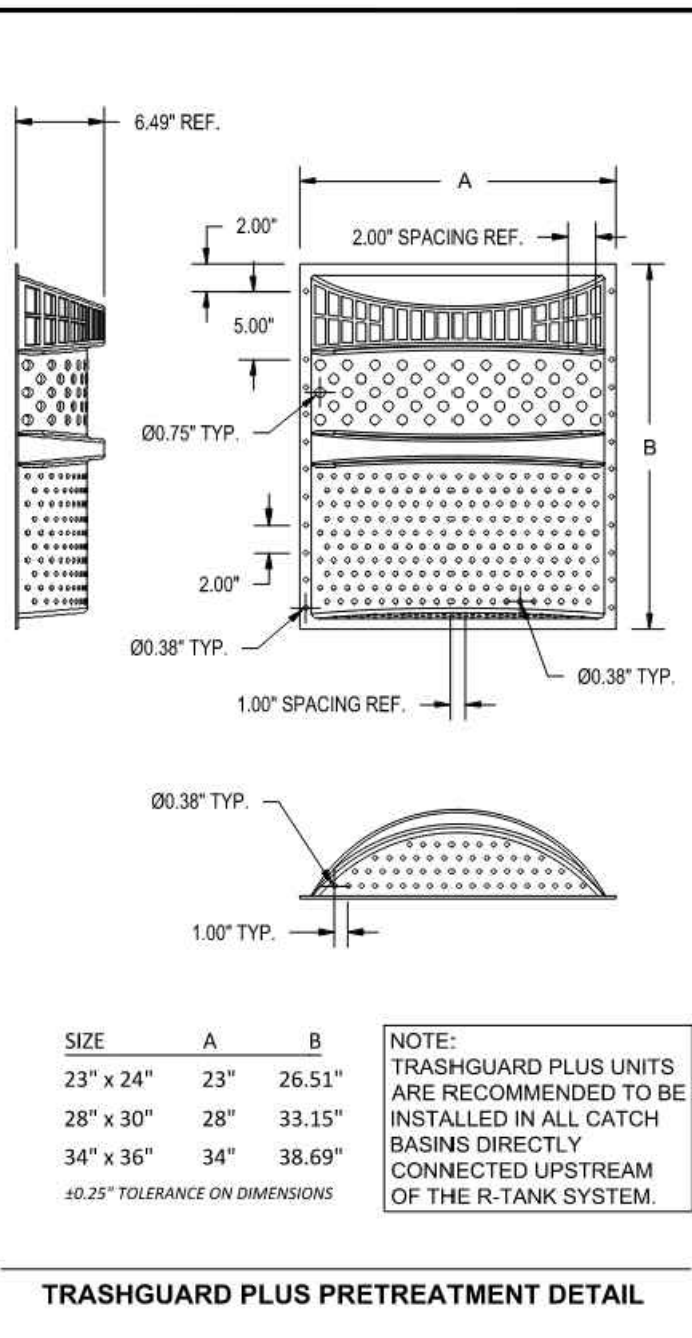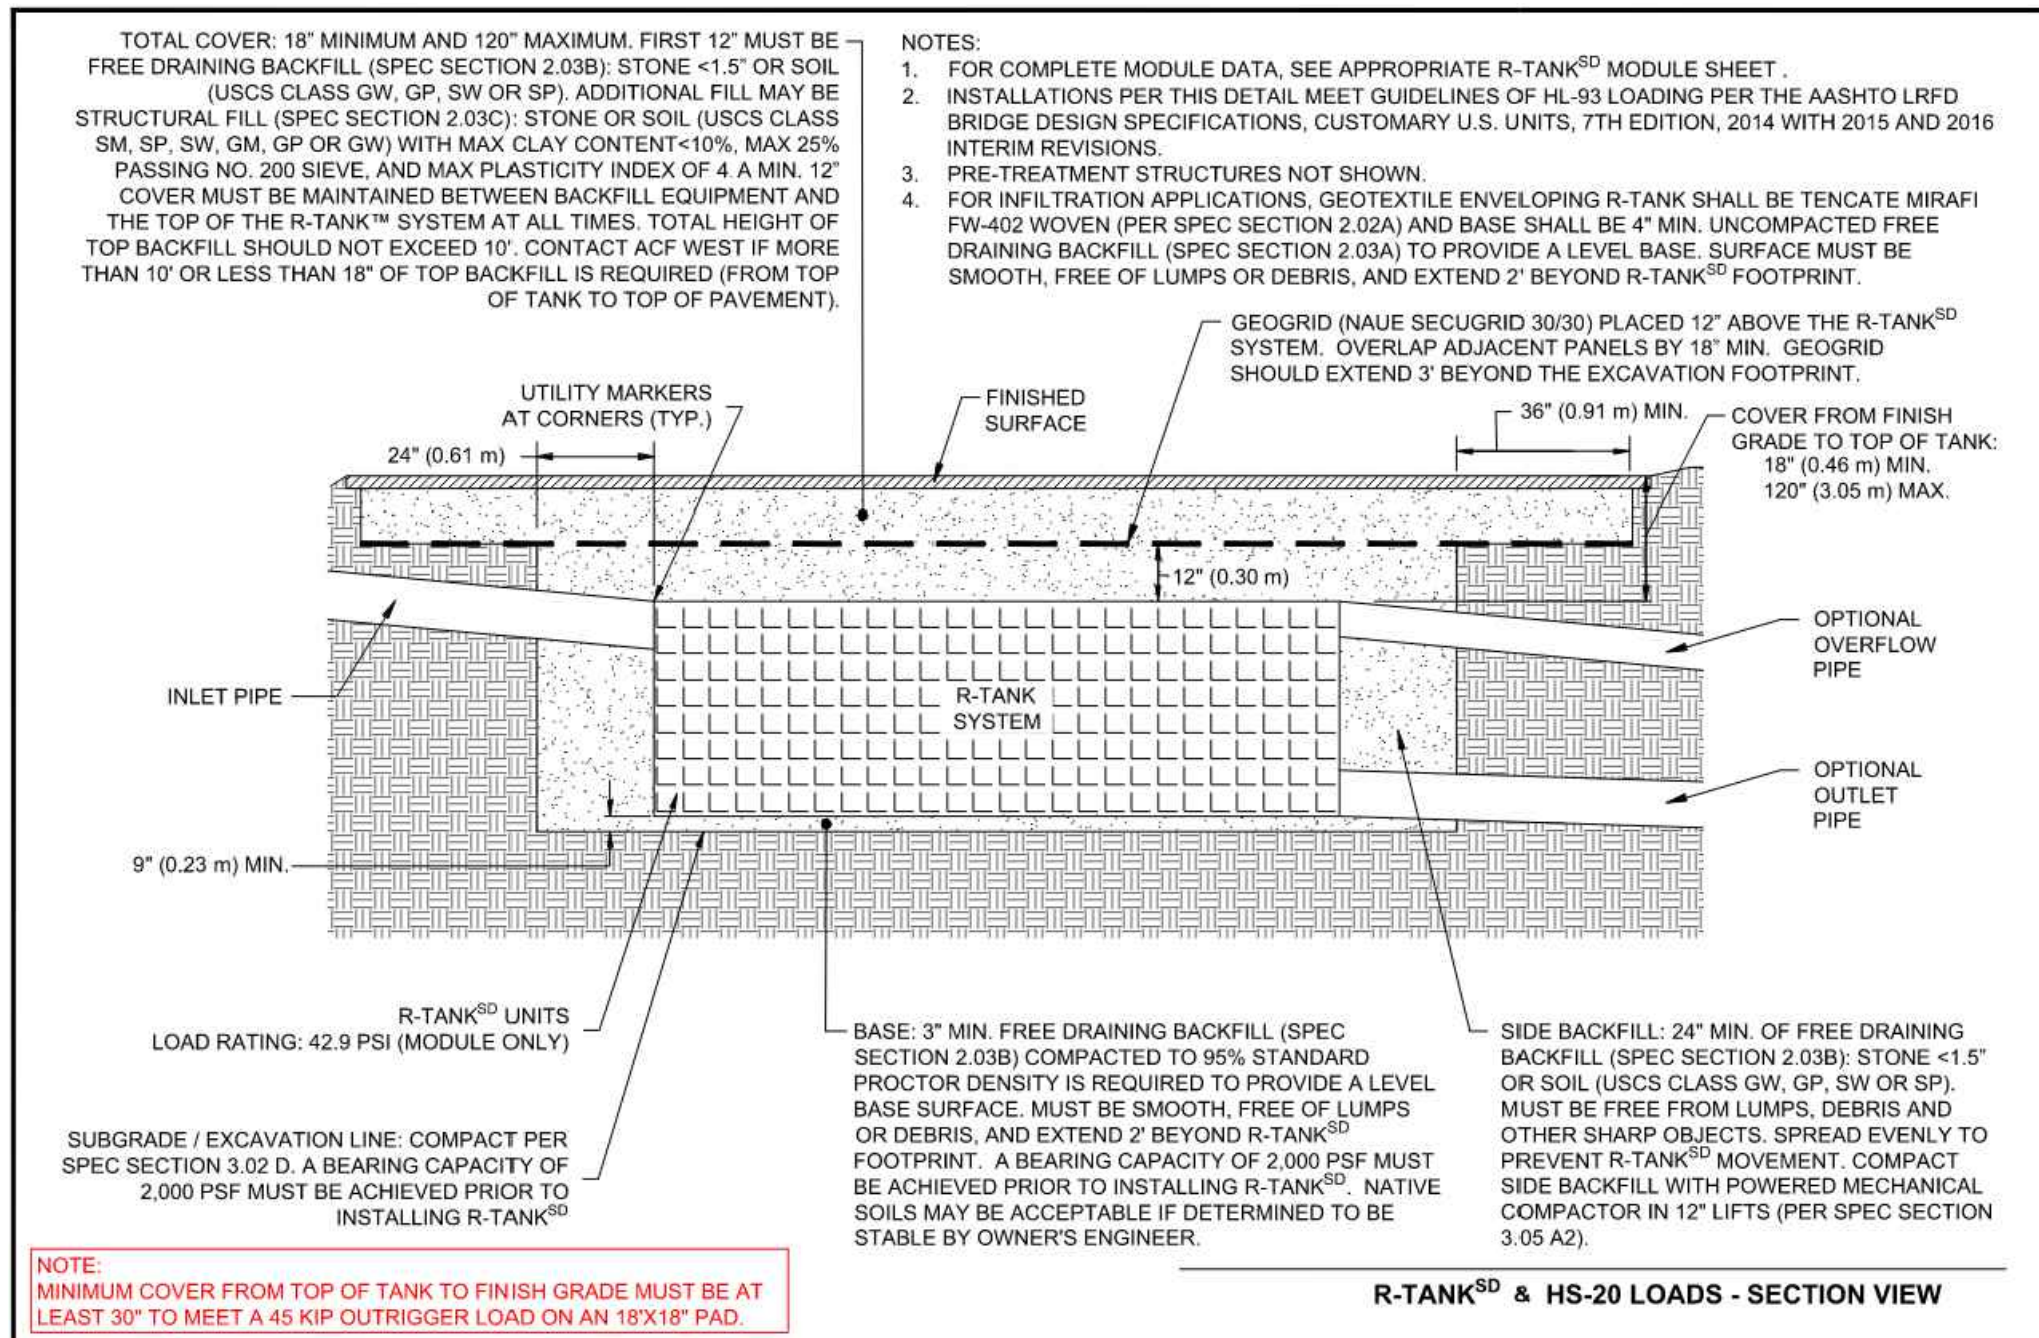

**R-TANK<sup>SD</sup> SYSTEM DETAILS**  
 EAST TOWN CROSSING  
 PUYALLUP, WA  
 SITE DESIGNATION: R-TANK 1  
 4 of 6

City of Puyallup Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:  
 03/29/24 CITY COMMENTS  
 01/29/24 CITY COMMENTS

Sheet Title:  
**R-TANK 1 NOTES AND DETAILS**

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI

Sheet No.  
**C4.11**  
 25 of 53 Sheets





# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY:   
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.



Project Title:  
**EAST TOWN CROSSING PHASE 1**  
 Client:  
**ASH DEVELOPMENT**  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM  
 Project No.  
 2230752  
 Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024




City of Puyallup Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS  
 01/29/24 CITY COMMENTS  
 Revisions:

Sheet Title:  
**R-TANK 1 NOTES AND DETAILS**  
 Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C4.12**  
 26 of 53 Sheets

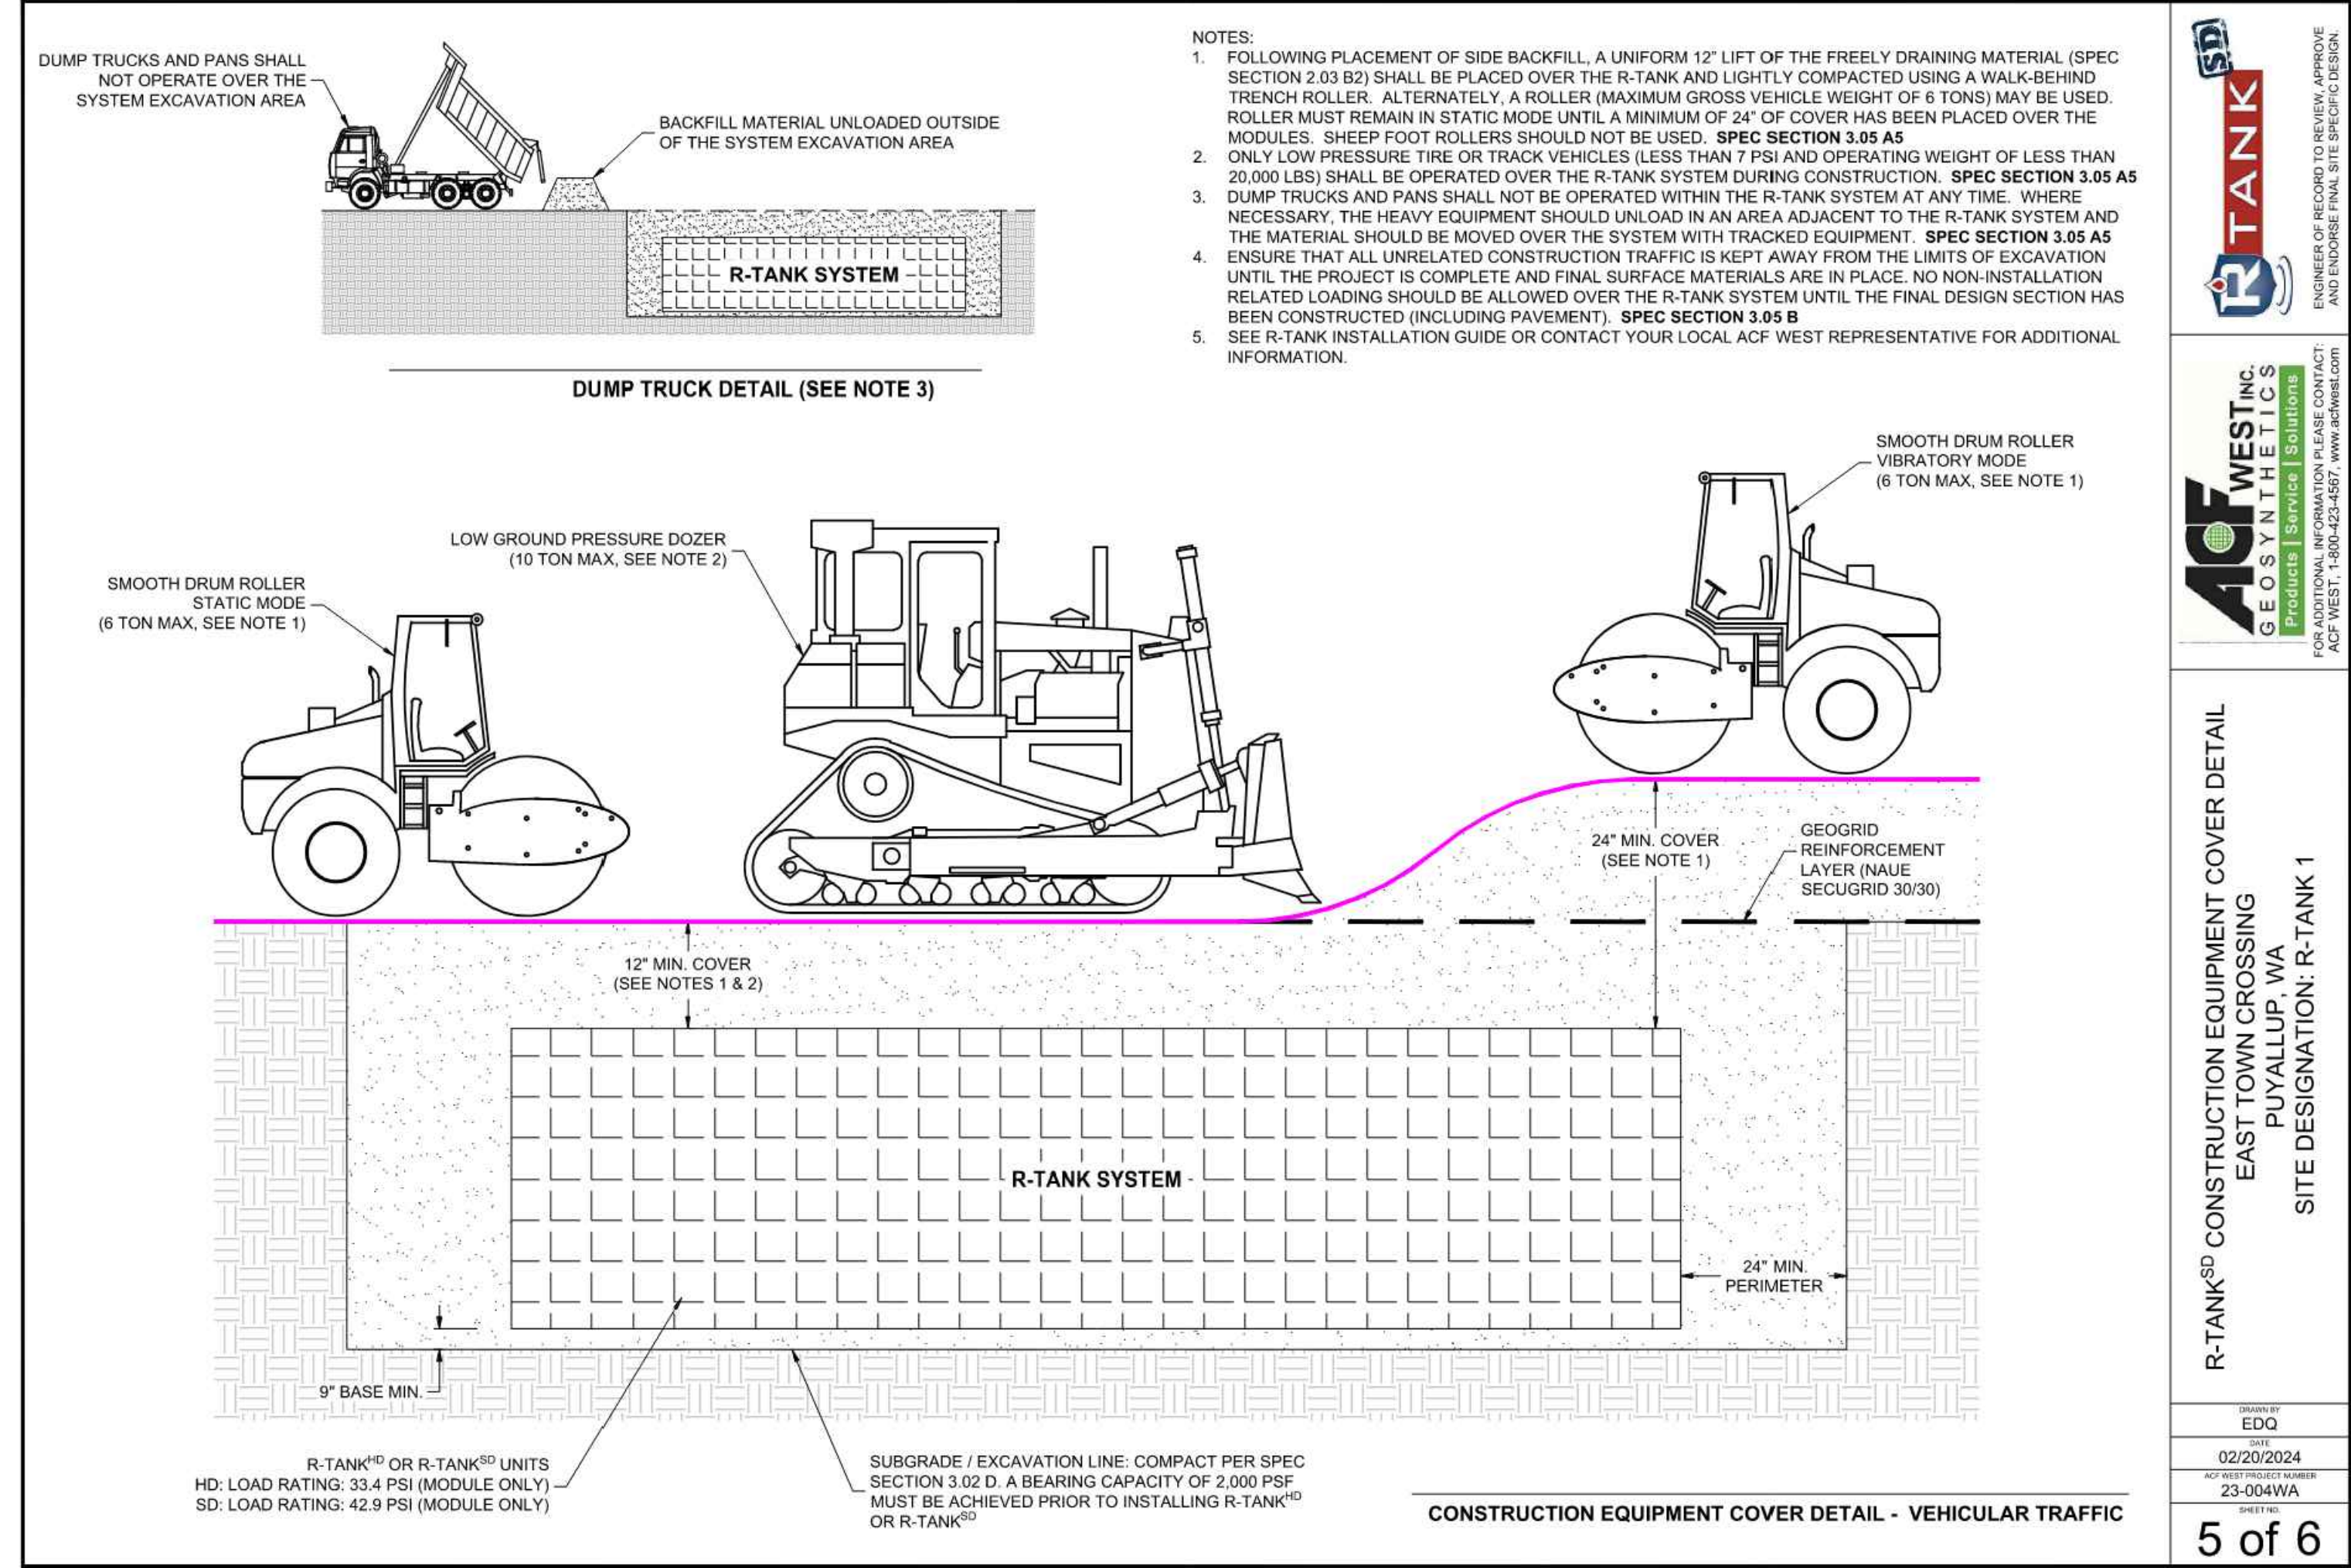

NOTES:  
 1. FOLLOWING PLACEMENT OF SIDE BACKFILL, A UNIFORM 12" LIFT OF THE FREELY DRAINING MATERIAL (SPEC SECTION 2.03 B2) SHALL BE PLACED OVER THE R-TANK AND LIGHTLY COMPACTED USING A WALK-BEHIND TRENCH ROLLER. ALTERNATELY, A ROLLER (MAXIMUM GROSS VEHICLE WEIGHT OF 6 TONS) MAY BE USED. ROLLER MUST REMAIN IN STATIC MODE UNTIL A MINIMUM OF 24" OF COVER HAS BEEN PLACED OVER THE MODULES. SHEEP FOOT ROLLERS SHOULD NOT BE USED. SPEC SECTION 3.05 A5  
 2. ONLY LOW PRESSURE TIRE OR TRACK VEHICLES (LESS THAN 7 PSI AND OPERATING WEIGHT OF LESS THAN 20,000 LBS) SHALL BE OPERATED OVER THE R-TANK SYSTEM DURING CONSTRUCTION. SPEC SECTION 3.05 A5  
 3. DUMP TRUCKS AND PANS SHALL NOT BE OPERATED WITHIN THE R-TANK SYSTEM AT ANY TIME. WHERE NECESSARY, THE HEAVY EQUIPMENT SHOULD UNLOAD IN AN AREA ADJACENT TO THE R-TANK SYSTEM AND THE MATERIAL SHOULD BE MOVED OVER THE SYSTEM WITH TRACKED EQUIPMENT. SPEC SECTION 3.05 A5  
 4. ENSURE THAT ALL UNRELATED CONSTRUCTION TRAFFIC IS KEPT AWAY FROM THE LIMITS OF EXCAVATION UNTIL THE PROJECT IS COMPLETE AND FINAL SURFACE MATERIALS ARE IN PLACE. NO NON-INSTALLATION RELATED LOADING SHOULD BE ALLOWED OVER THE R-TANK SYSTEM UNTIL THE FINAL DESIGN SECTION HAS BEEN CONSTRUCTED (INCLUDING PAVEMENT). SPEC SECTION 3.05 B  
 5. SEE R-TANK INSTALLATION GUIDE OR CONTACT YOUR LOCAL ACF WEST REPRESENTATIVE FOR ADDITIONAL INFORMATION.

**R-TANK<sup>SD</sup> CONSTRUCTION EQUIPMENT COVER DETAIL - PUYALLUP, WA SITE DESIGNATION: R-TANK 1**

REVISED: 02/20/2024  
 DATE: 23-004VA  
 SHEET: 5 of 6

**R-TANK SPECIFICATION**

PART 1 - GENERAL  
 1.01 RELATED DOCUMENTS  
 A. Drawings, technical specification and general provisions of the Contract as modified herein apply to this section.  
 1.02 DESCRIPTION OF WORK INCLUDED  
 A. Provide excavation and base preparation per geotechnical engineer's recommendations and/or as shown on the design drawings, to provide adequate support for project design loads and safety from excavation related collapse. Excavations shall be in accordance with the owner's and OSHA requirements.  
 B. Provide and install R-Tank, R-TankSD, or R-TankUD system (hereafter called R-Tank) and all related products including fill materials, geotextiles, geogrids, inlet and outlet pipes with connections per the manufacturer's installation guidelines provided in this section.  
 C. Protect R-Tank system from construction traffic after installation until completion of all construction activity in the installation area.  
 1.03 QUALITY CONTROL  
 A. All materials shall be manufactured in ISO certified facilities.  
 B. Installation Contractor shall demonstrate the following experience:  
 1. A minimum of three R-Tank or equivalent projects completed within 2 years; and  
 2. A minimum of 25,000 cubic feet of storage volume completed within 2 years;  
 C. Contractor experience requirement may be waived if the manufacturer's representative provides on-site training and review during construction.  
 D. Installation Personnel: Performed only by skilled workers with satisfactory record of performance on bulk earthworks, pipe, chamber, or pond/infill construction projects of comparable size and quality.  
 E. Contractor must have manufacturer's representative available for site review if requested by Owner.  
 1.04 SUBMITTALS  
 A. Submit proposed R-Tank layout drawings. Drawings shall include typical section details as well as the required base elevation of stone and tanks, minimum cover requirements and tank configuration.  
 B. Submit manufacturer's product data, including compressive strength and unit weight.  
 C. Submit manufacturer's installation instructions.  
 D. Submit R-Tank samples for review. Retrieved and accepted samples will be returned to the Contractor.  
 E. Submit material certificates for geotextile, geogrid, base course and backfill materials.  
 F. Submit required experience and personnel requirements as specified in Section 1.03.  
 G. Any proposed equal alternative product substitution to this specification must be submitted for review and approved prior to bid opening. Review package should include third party reviewed performance data that meets or exceeds criteria in Table 2.01 B.  
 1.05 DELIVERY, STORAGE, AND HANDLING  
 A. Protect R-Tank and other materials from damage during delivery, and store UV sensitive materials under tarp to protect from sunlight when time from delivery to installation exceeds two weeks. Storage of materials should be on smooth surfaces, free from dirt, mud and debris.  
 B. Handling is to be performed with equipment appropriate to the materials and site conditions, and may include hand, handcart, forklifts, extension ladders, etc.  
 C. Cold weather:  
 1. Care must be taken when handling plastics when air temperature is 40 degrees or below as plastic becomes brittle.  
 2. Do not use frozen materials or materials mixed or coated with ice or frost.  
 3. Do not build on frozen ground or wet, saturated or muddy subgrade.  
 1.06 PREINSTALLATION CONFERENCE  
 A. Prior to the start of the installation, a preinstallation conference shall occur with the representatives from the design team, the general contractor, the excavation contractor, the R-Tank installation contractor, and the manufacturer's representative.  
 1.07 PROJECT CONDITIONS  
 A. Coordinate installation for the R-Tank system with other on-site activities to eliminate all non-installation related construction traffic over the completed R-Tank system. No loads heavier than the design loads shall be allowed over the system, and in no case shall loads heavier than a standard ASHTO H20 or HS25, depending on design criteria, load be imposed on the system at any time.  
 B. Protect adjacent work from damage during R-Tank system installation.  
 C. All pre-treatment systems to remove debris and heavy sediments must be in place and functional prior to operation of the R-Tank system. Additional pretreatment measures may be needed if unit is operational during construction due to increased sediment loads.  
 D. Contractor is responsible for any damage to the system during construction.

PART 2 - PRODUCTS  
 2.01 R-TANK UNITS  
 A. R-Tank - injection molded plastic tank modules assembled to form a 95% void modular structure of pre-designed height (custom for each project).  
 B. R-Tank units shall meet the following Physical & Chemical Characteristics:

PROPERTY	UNITS	MINIMUM VALUE	MAXIMUM VALUE	TEST METHOD
Compressive Strength	psi	900	1000	ASTM D695
Flexural Strength	psi	1000	1100	ASTM D790
Impact Resistance	ft-lb	10	15	ASTM D256
Water Absorption	%	0.5	1.0	ASTM D153
Modulus of Elasticity	psi	150,000	180,000	ASTM D2838
Tensile Strength	psi	1500	1800	ASTM D638
Elongation at Break	%	5	10	ASTM D638
Chemical Resistance				ASTM D543
Temperature Range	F	-40	120	

C. Supplier: ACF West 15540 Woodville-Rodmond Rd., Woodville, Washington 98072, (425) 415-6115, www.acfwest.com  
 2.02 GEOSYNTHETICS  
 A. Geotextile: A geotextile envelope is required to prevent backfill material from entering the R-Tank modules.  
 B. Standard Application: 16oz woven geotextile shall be an 8' or square and woven geotextile (TerCain M1800 or equivalent).  
 C. Infiltration Applications: When water must infiltrate through the geotextile as a function of the system design, a woven monofilament (TerCain M1640 or equivalent) shall be used.  
 D. Geogrid: For installations subject to traffic loads and/or when required by project plans, install geogrid (Nasud Geogrid 3030 or equivalent) to reinforce backfill over the R-Tank system. Geogrid is not always required for R-TankSD installations, and is not required for non-traffic load applications.  
 E. MANUFACTURED 30 MIL. (MIN) IMPERMEABLE LINER TO PREVENT GROUNDWATER INTRUSION.  
 2.03 BACKFILL & COVER MATERIALS  
 A. Backfill Materials: Stone (angular and smaller than 1.5" in diameter) or soil (GW, GP, SW, or SP as classified by the Unified Soil Classification System) shall be used below the R-Tank system (2" minimum). Material must be free from lumps, debris, and any sharp objects that could cut the geotextile. Material shall be within 3 percent of the optimum moisture content as determined by ASTM D698 at the time of installation. For infiltration applications bedding material shall be free draining.  
 B. Side and Top Backfill: Material must be free from lumps, debris and any sharp objects that could cut the geotextile. Material shall be within 3 percent of the optimum moisture content as determined by ASTM D698 at the time of installation.  
 C. Traffic Applications: Free draining material shall be used adjacent to (24" minimum) and above (for less than 12" the R-Tank system).  
 D. For HD, and SD modules, backfill materials shall be free draining stone (angular and smaller than 1.5" in diameter) or soil (GW, GP, SW, or SP as classified by the Unified Soil Classification System).  
 E. For LD modules with less than 14" of top cover, backfill materials shall be free draining stone (angular and smaller than 1.5" in diameter). The use of soil backfill on the sides and top of the LD module is not permitted unless the modules are installed outside of traffic areas or with cover depths of 14" or more. Top backfill material (from top of module to bottom of pavement base or 12" maximum) must be consistent with site base/HD.  
 F. Non-Traffic / Green Space Applications: For all R-Tank modules installed in green spaces and not subjected to vehicular loads, backfill materials may either follow the guidelines for Traffic Applications above, or the top backfill layer (12" minimum) may consist of ASTM D857 stone blended with 30-40% (by volume) tested to and installed in stabilizing vegetation.  
 G. Additional Cover Materials: Structural Fill shall consist of granular materials meeting the gradation requirements of SM, SP, SW, GM, GP or GW as classified by the Unified Soil Classification System. Structural Fill shall have a maximum of 25 percent fines and shall have a maximum clay content of 10 percent and a maximum Plasticity Index of 4. Material shall be within 3 percent of the optimum moisture content as determined by ASTM D698 at the time of installation.

2.04 OTHER MATERIALS  
 A. Utility Marker: Install metallic tape at corners of R-Tank system to mark the area for future utility detection.  
 3.01 ASSEMBLY OF R-TANK UNITS  
 A. Assembly of modules shall be performed in accordance with the R-Tank Installation Manual, Section 2.  
 3.02 LAYOUT AND EXCAVATION  
 A. Excavation shall start and excavate, and prepare the subgrade area to the required plan grades and dimensions, ensuring that the excavation is at least 2 feet greater than R-Tank dimensions in each direction allowing for installation of geotextile liner fabric, R-Tank modules, and free draining backfill materials.  
 B. Excavations must be prepared with OSHA approved excavated sides and sufficient working space.  
 C. Protect partially completed installation against damage from other construction traffic by establishing a perimeter with high visibility construction tape, fencing, barricades, or other means until construction is complete.  
 D. Base of the excavation shall be uniform, level, and free of lumps or debris and soft or yielding subgrade areas. A minimum 2,000 pounds per square foot bearing capacity is required.  
 E. Infiltration Applications: Subgrade shall be prepared in accordance with the contract documents. Compaction of subgrade should not be performed in infiltration applications.  
 F. Unsuitable Soils or Conditions: All questions about the base of the excavation shall be directed to the owner's engineer, who will approve the subgrade conditions prior to placement of stone. The owner's engineer shall determine the required bearing capacity of the R-Tank subgrade; however, in no case shall the bearing capacity be less than 2,000 pounds per square foot be provided.  
 1. If unsuitable soils are encountered at the subgrade, or if the subgrade is pumping or appears excessively soft, repair the area in accordance with contract documents and/or as directed by the owner's engineer.  
 2. If indications of the water table are observed during excavation, the engineer shall be contacted to provide recommendations.  
 3. Do not start installation of the R-Tank system until satisfactory subgrade conditions are corrected and the subgrade conditions are accepted by the owner's engineer.  
 3.03 PREPARATION OF BASE  
 A. Place a thin layer (1" unless otherwise specified) of bedding material (Section 2.03 A), over the subgrade to establish a level working platform for the R-Tank modules. Level to within 1/4" (+/- 1/2") or as shown on the plans. Native subgrade soils or other materials may be used if determined to meet the requirements of 2.03 A and are accepted by the owner's engineer.  
 1. Standard Applications: Static roll or otherwise compact bedding materials until they are firm and unyielding.  
 2. Infiltration Applications: Bedding materials shall be prepared in accordance with the contract documents.  
 B. Outline the footprint of the R-Tank system on the excavation floor using spray paint or chalk line to ensure a 2" perimeter is available around the R-Tank system for proper installation and compaction of backfill.  
 3.04 INSTALLATION OF THE R-TANKS  
 A. Where a geotextile wrap is specified on the stone base, cut strips to length and install in excavation, removing wrinkles so material lays flat. Overlay geotextile a minimum 12" or as recommended by manufacturer. Use tape, special adhesives, sandbags or other means to secure overlaps. As geotextile can be damaged by extreme heat, smoking is not permissible on-site. Fuel, oil, and any other petroleum products of the geotextile (and optional liner). These conditions should be installed flush (flushed to the R-Tank) and the geotextile fabric shall be cut to enable hydraulic continuity between the connections and the R-Tank units. These connections shall be secured using pipe boots with stainless steel stop clamps. Support pipe installation. Backfill operations to prevent pipe from settling and ensuring the geotextile, impervious liner (if specified) or pipe. Connecting pipes at 90 degree angles facilitates installation, unless otherwise specified. Ensure end of pipe is installed into adjacent R-Tank system.  
 B. Install R-Tank modules by placing side by side, in accordance with the design drawings. No lateral connections are required. It is advisable to use a string line to form square corners and straight edges along the perimeter of the R-Tank system. The modules are to be oriented as per the design drawings with required depth as shown on plans.  
 1. For LD, HD, and SD installations, the large side plate of the tank should be placed on the perimeter of the system. This will typically require that the two ends of the tank area will have a row of tanks placed perpendicular to all other tanks. If this is not shown in the construction drawings, it is a simple field adjustment that will have minimal effect on the overall system footprint. Refer to R-Tank Installation Guide for more details.  
 2. For UD installations, there is no perpendicular and row required.  
 C. Prep the R-Tank top and sides in specified geotextile. Cut strips of geotextile so that it will cover the sides and top, encapsulating the entire system to prevent backfill entry into the system. Overlay geotextile 12" or as recommended by manufacturer. Take great care to avoid damage to geotextile (and, if specified, impervious liner) during placement.  
 D. Identify locations of inlet, outlet and any other penetrations of the geotextile (and optional liner). These connections should be installed flush (flushed to the R-Tank) and the geotextile fabric shall be cut to enable hydraulic continuity between the connections and the R-Tank units. These connections shall be secured using pipe boots with stainless steel stop clamps. Support pipe installation. Backfill operations to prevent pipe from settling and ensuring the geotextile, impervious liner (if specified) or pipe. Connecting pipes at 90 degree angles facilitates installation, unless otherwise specified. Ensure end of pipe is installed into adjacent R-Tank system.  
 E. Additional layers of geotextile and/or geogrid are locations noted on plans. At a minimum one maintenance during backfill operations. Each layer of geotextile/reinforcement placed above the R-Tank system shall extend a minimum of 3 feet beyond the limits of the excavation wall.  
 F. For LD, HD, and SD installations, the large side plate of the tank should be placed on the perimeter of the system. This will typically require that the two ends of the tank area will have a row of tanks placed perpendicular to all other tanks. If this is not shown in the construction drawings, it is a simple field adjustment that will have minimal effect on the overall system footprint. Refer to R-Tank Installation Guide for more details.  
 G. If required, install vent pipes and vents as specified on drawings to provide ventilation for proper hydraulic performance. The number of pipes and vents will depend on the size of the system. Vents are often installed using a 90 degree elbow with PVC pipe into a landscaped area with "U" bend or venting bollard to inhibit the ingress of debris. A ground level concrete or steel cover can be used.  
 3.05 BACKFILL OF THE R-TANK SYSTEMS  
 A. Place freely draining backfill materials (Section 2.03 B) around the perimeter in lifts with a maximum thickness of 12". Each lift shall be placed around the entire perimeter such that each lift is no more than 24" higher than the side backfill along any other location on the perimeter of the R-Tank system. No lift shall be placed over top of tanks until the side backfill has been compacted.  
 2. Each lift shall be compacted at the specified moisture content to a minimum of 95% of the Standard Proctor Density until no further densification is observed (for self-compacting stone materials). The side lifts must be compacted with walk behind compaction equipment. Even when "self-compacting" backfill materials are selected, a walk behind vibratory compactor must be used.  
 3. Take care to ensure that the compaction process does not allow the machinery to come into contact with the modules due to the potential for damage to the geotextile and R-Tank units.  
 4. No compaction equipment is permissible to operate directly on the R-Tank modules.  
 5. Top Backfill: Only low pressure track vehicles shall be permitted over the R-Tank system during construction. Dump Trucks and Pans shall not be operated within the R-Tank system footprint at any time. Heavy equipment should unload in an area adjacent to the R-Tank system and the material should be moved over the system using tracked equipment with an operating weight of less than 10 tons.  
 a. Typical Applications: Install a 12" of cover as shown on plans (if not shown on plans) over the R-Tank Units, maintaining 12" between equipment tracks and R-Tank System. Lightly compact using a walk-behind trench roller. Alternatively, a roller (maximum gross vehicle weight of 6 tons) may be used. Roller must remain in static mode and a minimum of 24" of cover has been placed over the modules. Sheep foot rollers should not be used.  
 b. Shallow Applications (4" to 12" total cover): Install top backfill in accordance with plans.  
 c. Traffic Applications: Free draining material shall be used adjacent to (24" minimum) and above (for less than 12" the R-Tank system).  
 D. Ensure that all unrelated construction traffic is kept away from the limits of excavation until the project is complete and final surface materials are in place. No non-installation related loading should be allowed over the R-Tank system until the final design section has been constructed (including pavement).  
 E. Place surface materials, such as groundcover (no large trees), or paving materials over the structure with care to avoid displacement of cover fill or damage to surrounding areas.  
 F. Backfill depth over R-Tank system must be within the limitations shown in the table in Section 2.01 B. If the total backfill depth does not comply with this table, contact engineer or manufacturer's representative for assistance.  
 3.06 MAINTENANCE REQUIREMENTS  
 A. Routine maintenance effort is required to ensure proper performance of the R-Tank system. The Maintenance program should be based on pre-treatment systems. Ensuring these structures are clean and functioning properly will reduce the risk of contamination of the R-Tank system and stormwater released from the site. The treatment systems shall be inspected yearly, or as directed by the regulatory agency and by the Manufacturer (for proprietary systems). Maintain an accurate record of acceptable practices or following manufacturer's guidelines (for proprietary systems).  
 B. All inlet pipes and Inspection and/or Maintenance Ports in the R-Tank system will need to be inspected for accumulation of sediments at least quarterly through the first year of operation and at least yearly thereafter.  
 C. If sediment has accumulated to the level noted in the R-Tank Maintenance Guide or beyond a level acceptable to the Owner's engineer, the R-Tank system should be flushed.  
 D. All inspection and maintenance activities should be performed in accordance with the R-Tank Operation, Inspection & Maintenance Manual.

**811**  
 Know what's below.  
 Call before you dig.



# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.  
 THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.  
 FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.



Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**

05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INDICATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OR WARRANTY BY THE ENGINEER OR ARCHITECT. THE ENGINEER OR ARCHITECT SHALL BE RESPONSIBLE FOR THE DESIGN AND CONSTRUCTION OF THE PROJECT. THIS DOCUMENT IS NOT TO BE USED FOR ANY OTHER PROJECT OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**


Building	Planning
Engineering	Public Works
Fire	Traffic

- △
  - △
  - △ 03/29/24 CITY COMMENTS
  - △ 01/29/24 CITY COMMENTS
- Revisions:

Sheet Title:  
**R-TANK 2 NOTES AND DETAILS**

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI


Sheet No.  
**C4.20**  
 27 of 53 Sheets

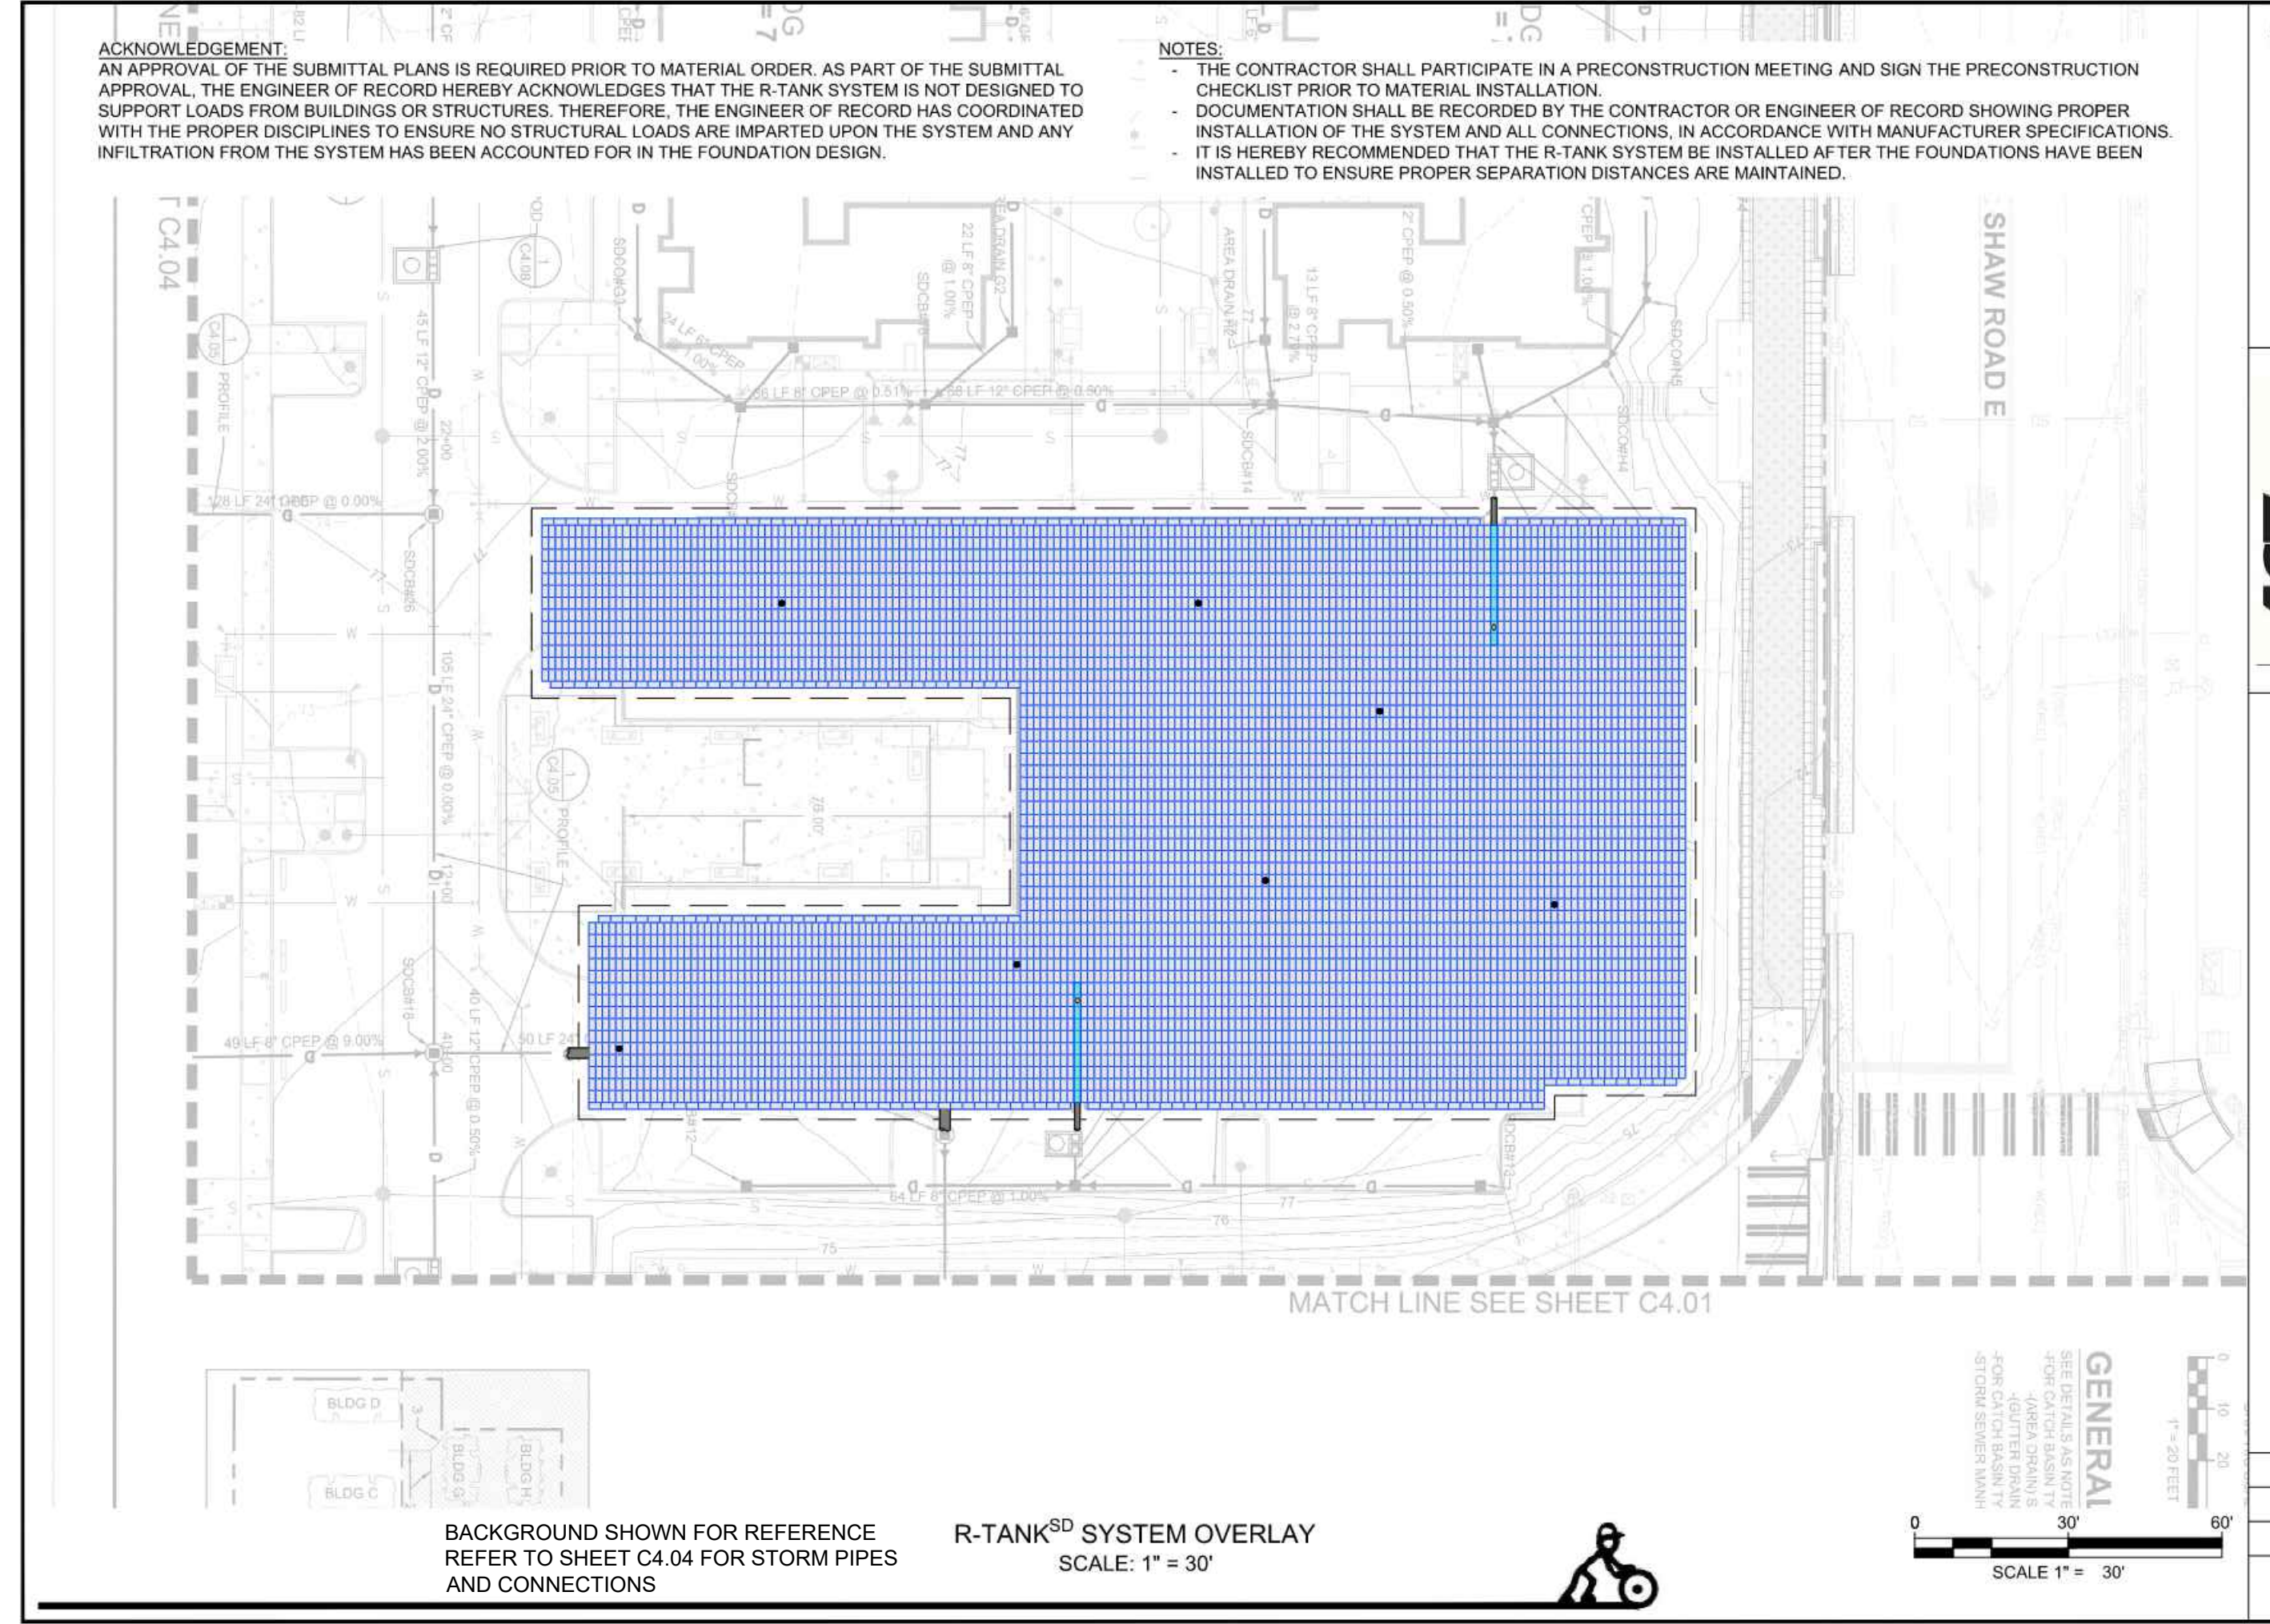

**R-TANK<sup>SD</sup> SYSTEM OVERLAY EAST TOWN CROSSING PUYALLUP, WA SITE DESIGNATION: R-TANK 2**

EDG  
 02/21/2024  
 23-004WA


1 of 8

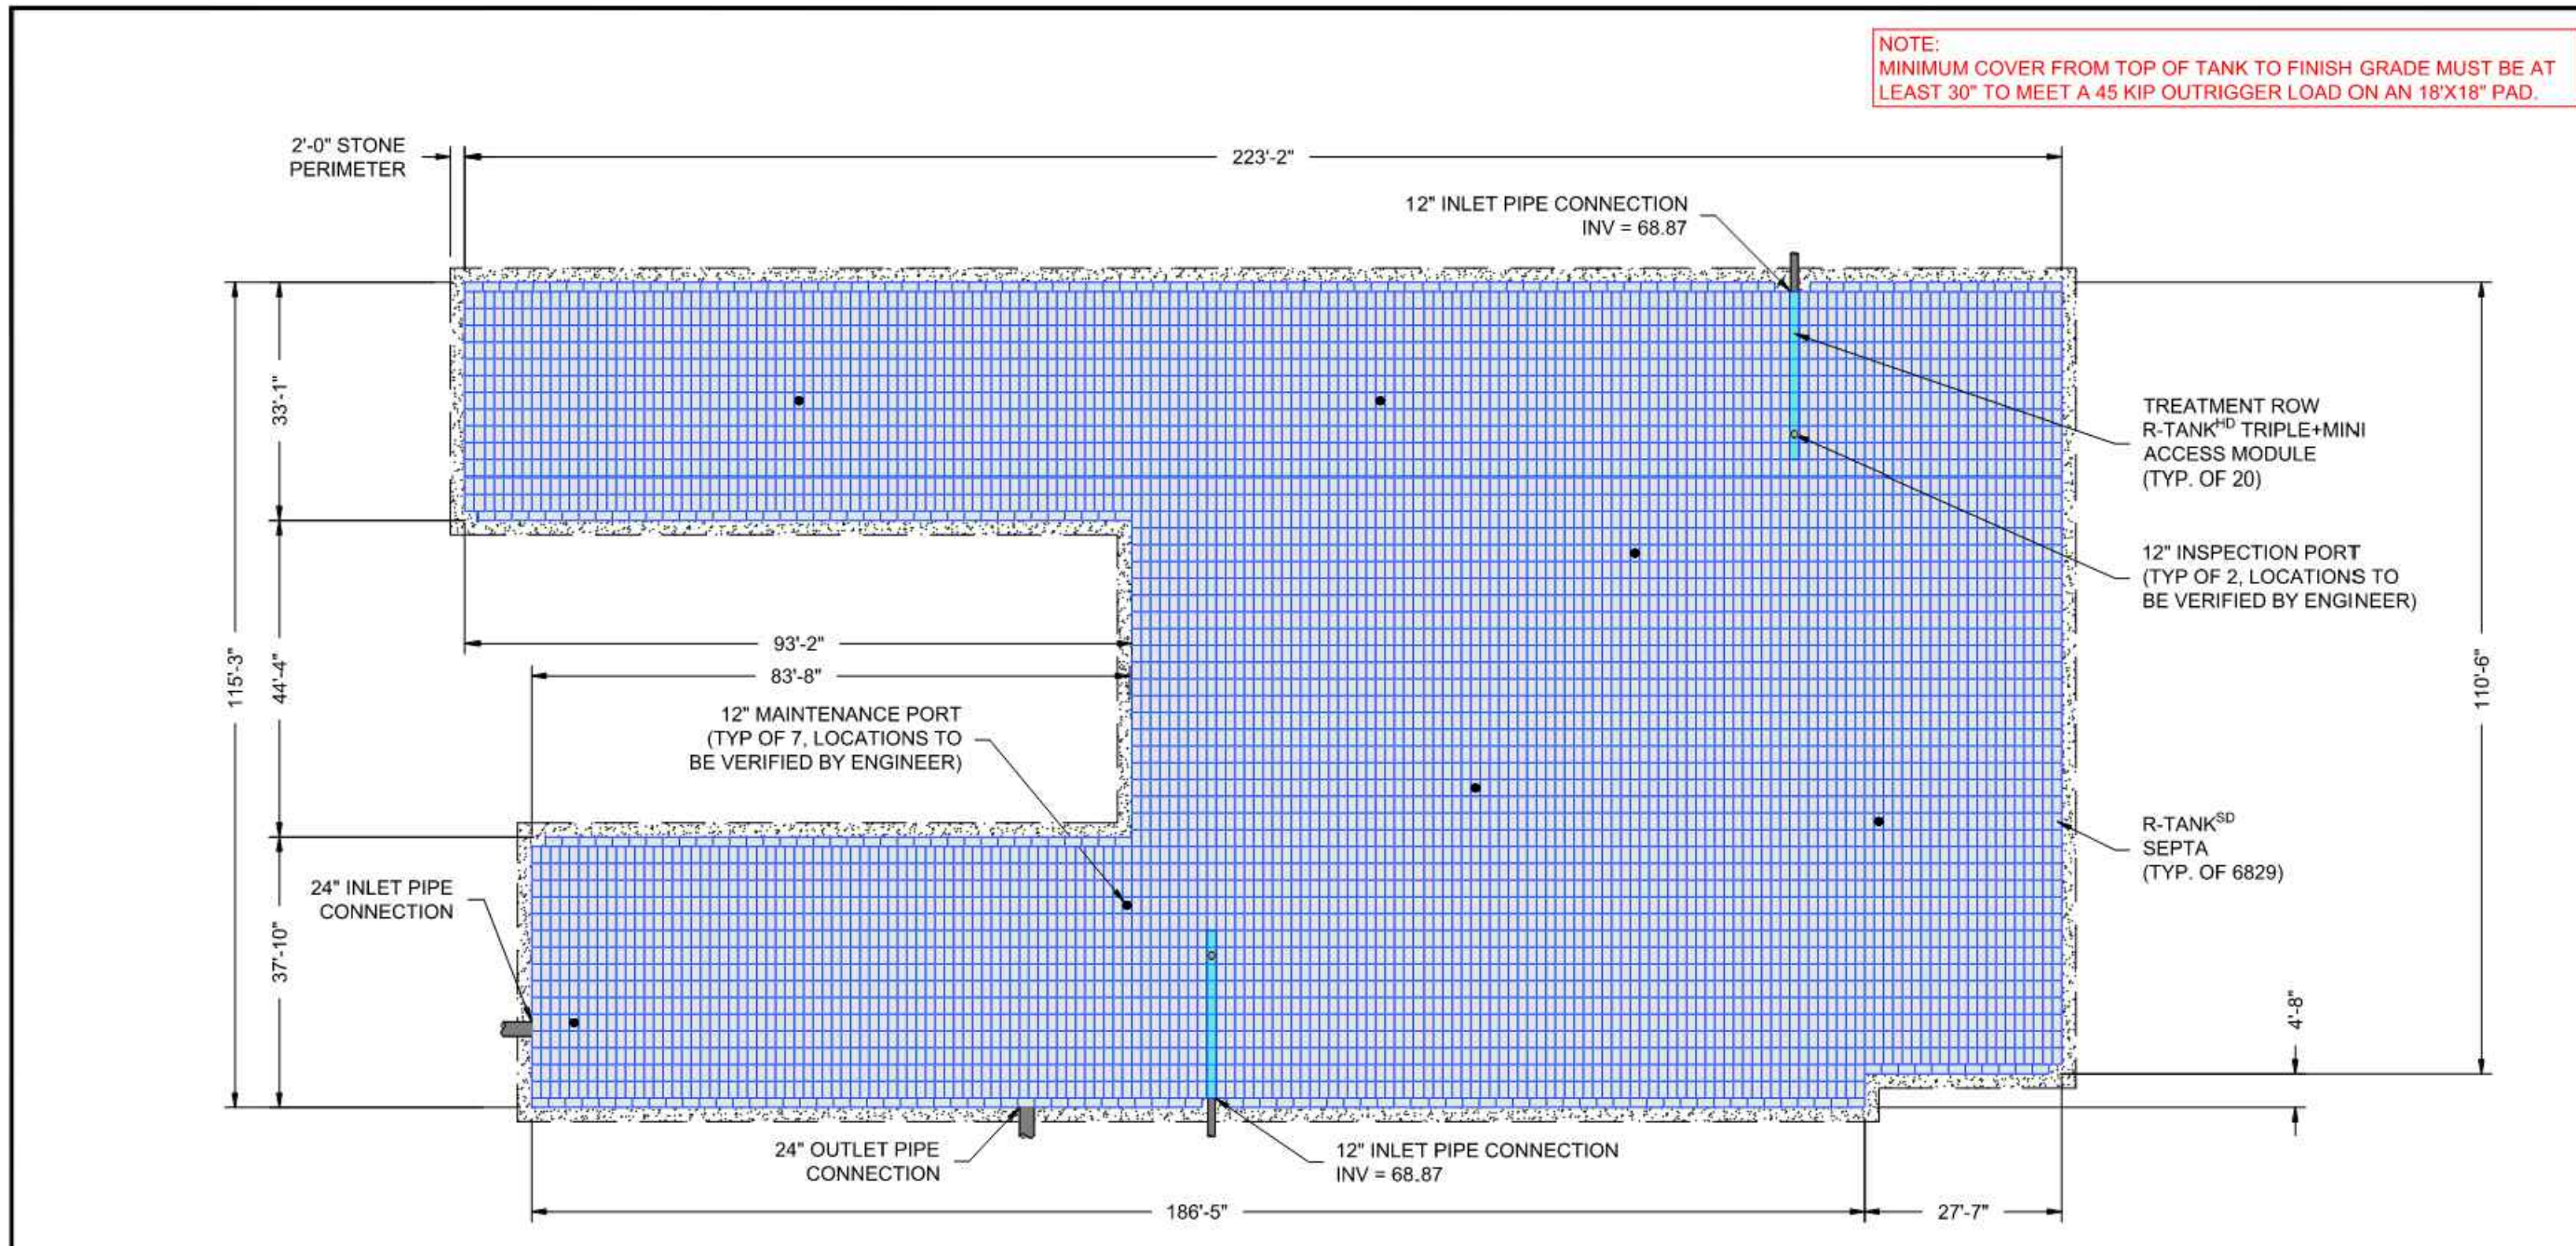

NOTES:  
 1. DEAD STORAGE VOLUME FROM ELEVATION 67.90 TO 68.40 = 4,562 CF  
 2. LIVE STORAGE VOLUME FROM ELEVATION 68.40 TO 74.27 = 112,902 CF  
 3. ONLY 3" OF BASE STONE INCLUDED IN LIVE STORAGE VOLUME.

LAYOUT SCALE	1" = 25'
R-TANK <sup>SD</sup> MODULE TYPE	SEPTA
TRAFFIC LOAD	45 KIP OUTRIGGER (18"x18")
# OF SD SEPTA R-TANKS	6,829
# OF HD DOUBLE+MINI R-TANK ACCESS MODULES	20
TOTAL SYSTEM STORAGE	112,902 CF
R-TANK STORAGE VOLUME	102,518 CF
STONE STORAGE VOLUME (40% VOID RATIO)	10,384 CF
TOP OF COVER STONE ELEV. (12")	74.77
NAUE SECUGRID 30/30 GEOGRID ELEV.	74.77
TOP OF R-TANK ELEV.	73.77
TANK INVERT	68.65
INVERT OF STONE BASE (6")	67.90
MIN. STONE PERIMETER WIDTH	2.0 FT

SEE SHEETS 3 - 8 FOR DETAILS AND ADDITIONAL INFORMATION

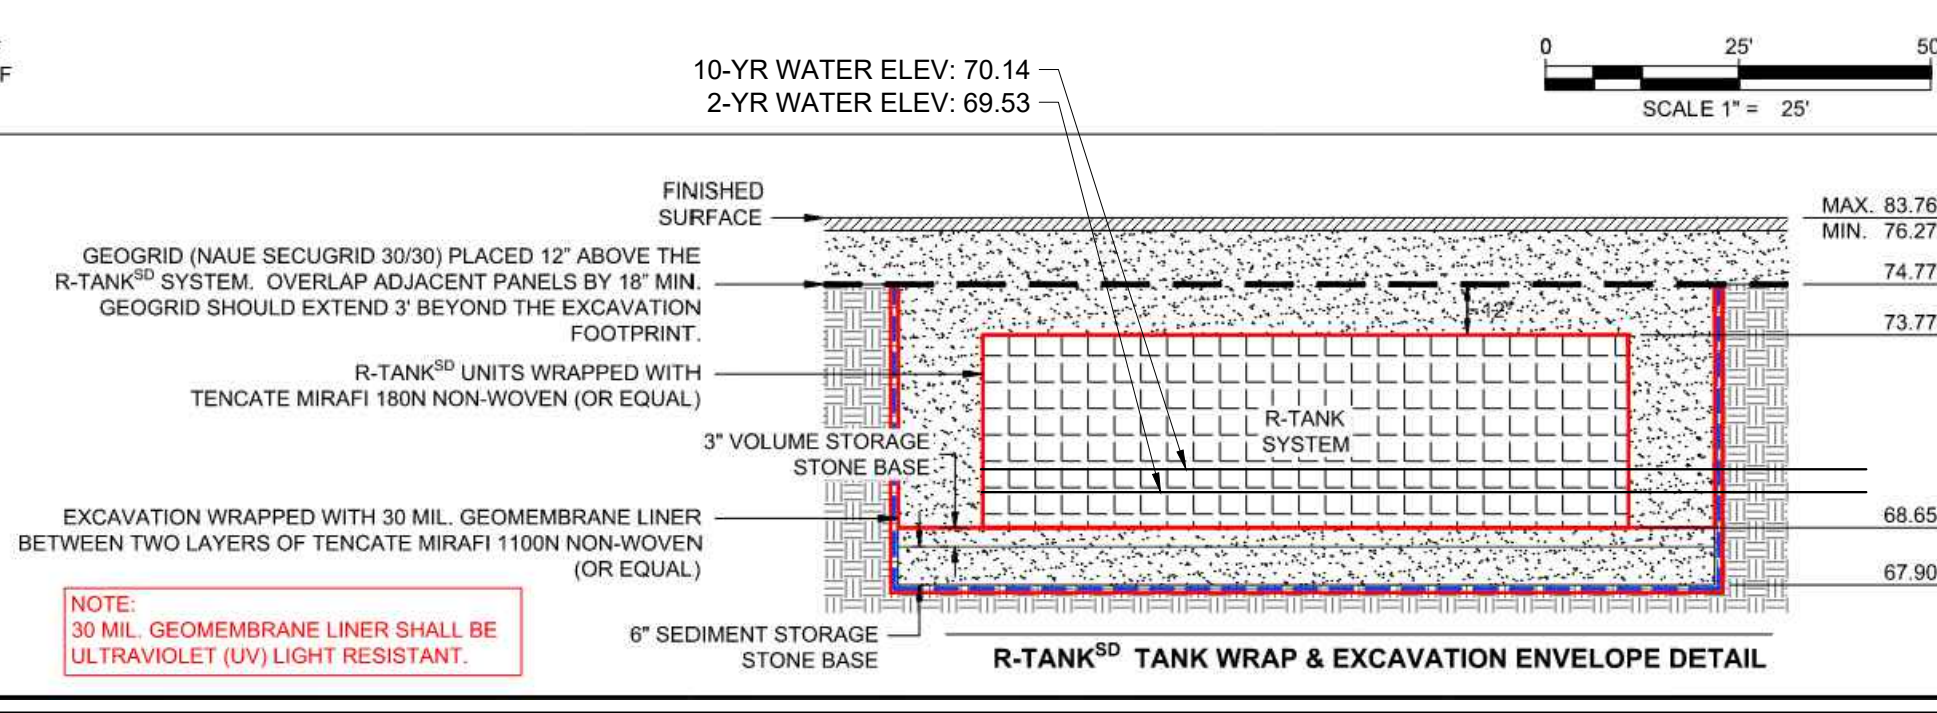

**R-TANK<sup>SD</sup> SYSTEM LAYOUT EAST TOWN CROSSING PUYALLUP, WA SITE DESIGNATION: R-TANK 2**

EDG  
 02/21/2024  
 23-004WA

2 of 8

**811**  
 Know what's below.  
 Call before you dig.



# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.



TACOMA • SEATTLE • SPOKANE • TRI-CITIES

2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:

### EAST TOWN CROSSING PHASE 1

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:

### PERMIT SUBMITTAL

05/17/2024



NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A WARRANTY OR ENDORSEMENT BY THE ENGINEER OR ARCHITECT. THE ENGINEER OR ARCHITECT IS NOT TO BE HELD RESPONSIBLE FOR ANY ERRORS OR OMISSIONS IN THIS DOCUMENT OR FOR ANY DAMAGE TO PROPERTY OR PERSONS ARISING FROM THE USE OF THIS DOCUMENT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title:


### R-TANK 2 NOTES AND DETAILS

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI

Sheet No.

## C4.21

28 of 53 Sheets

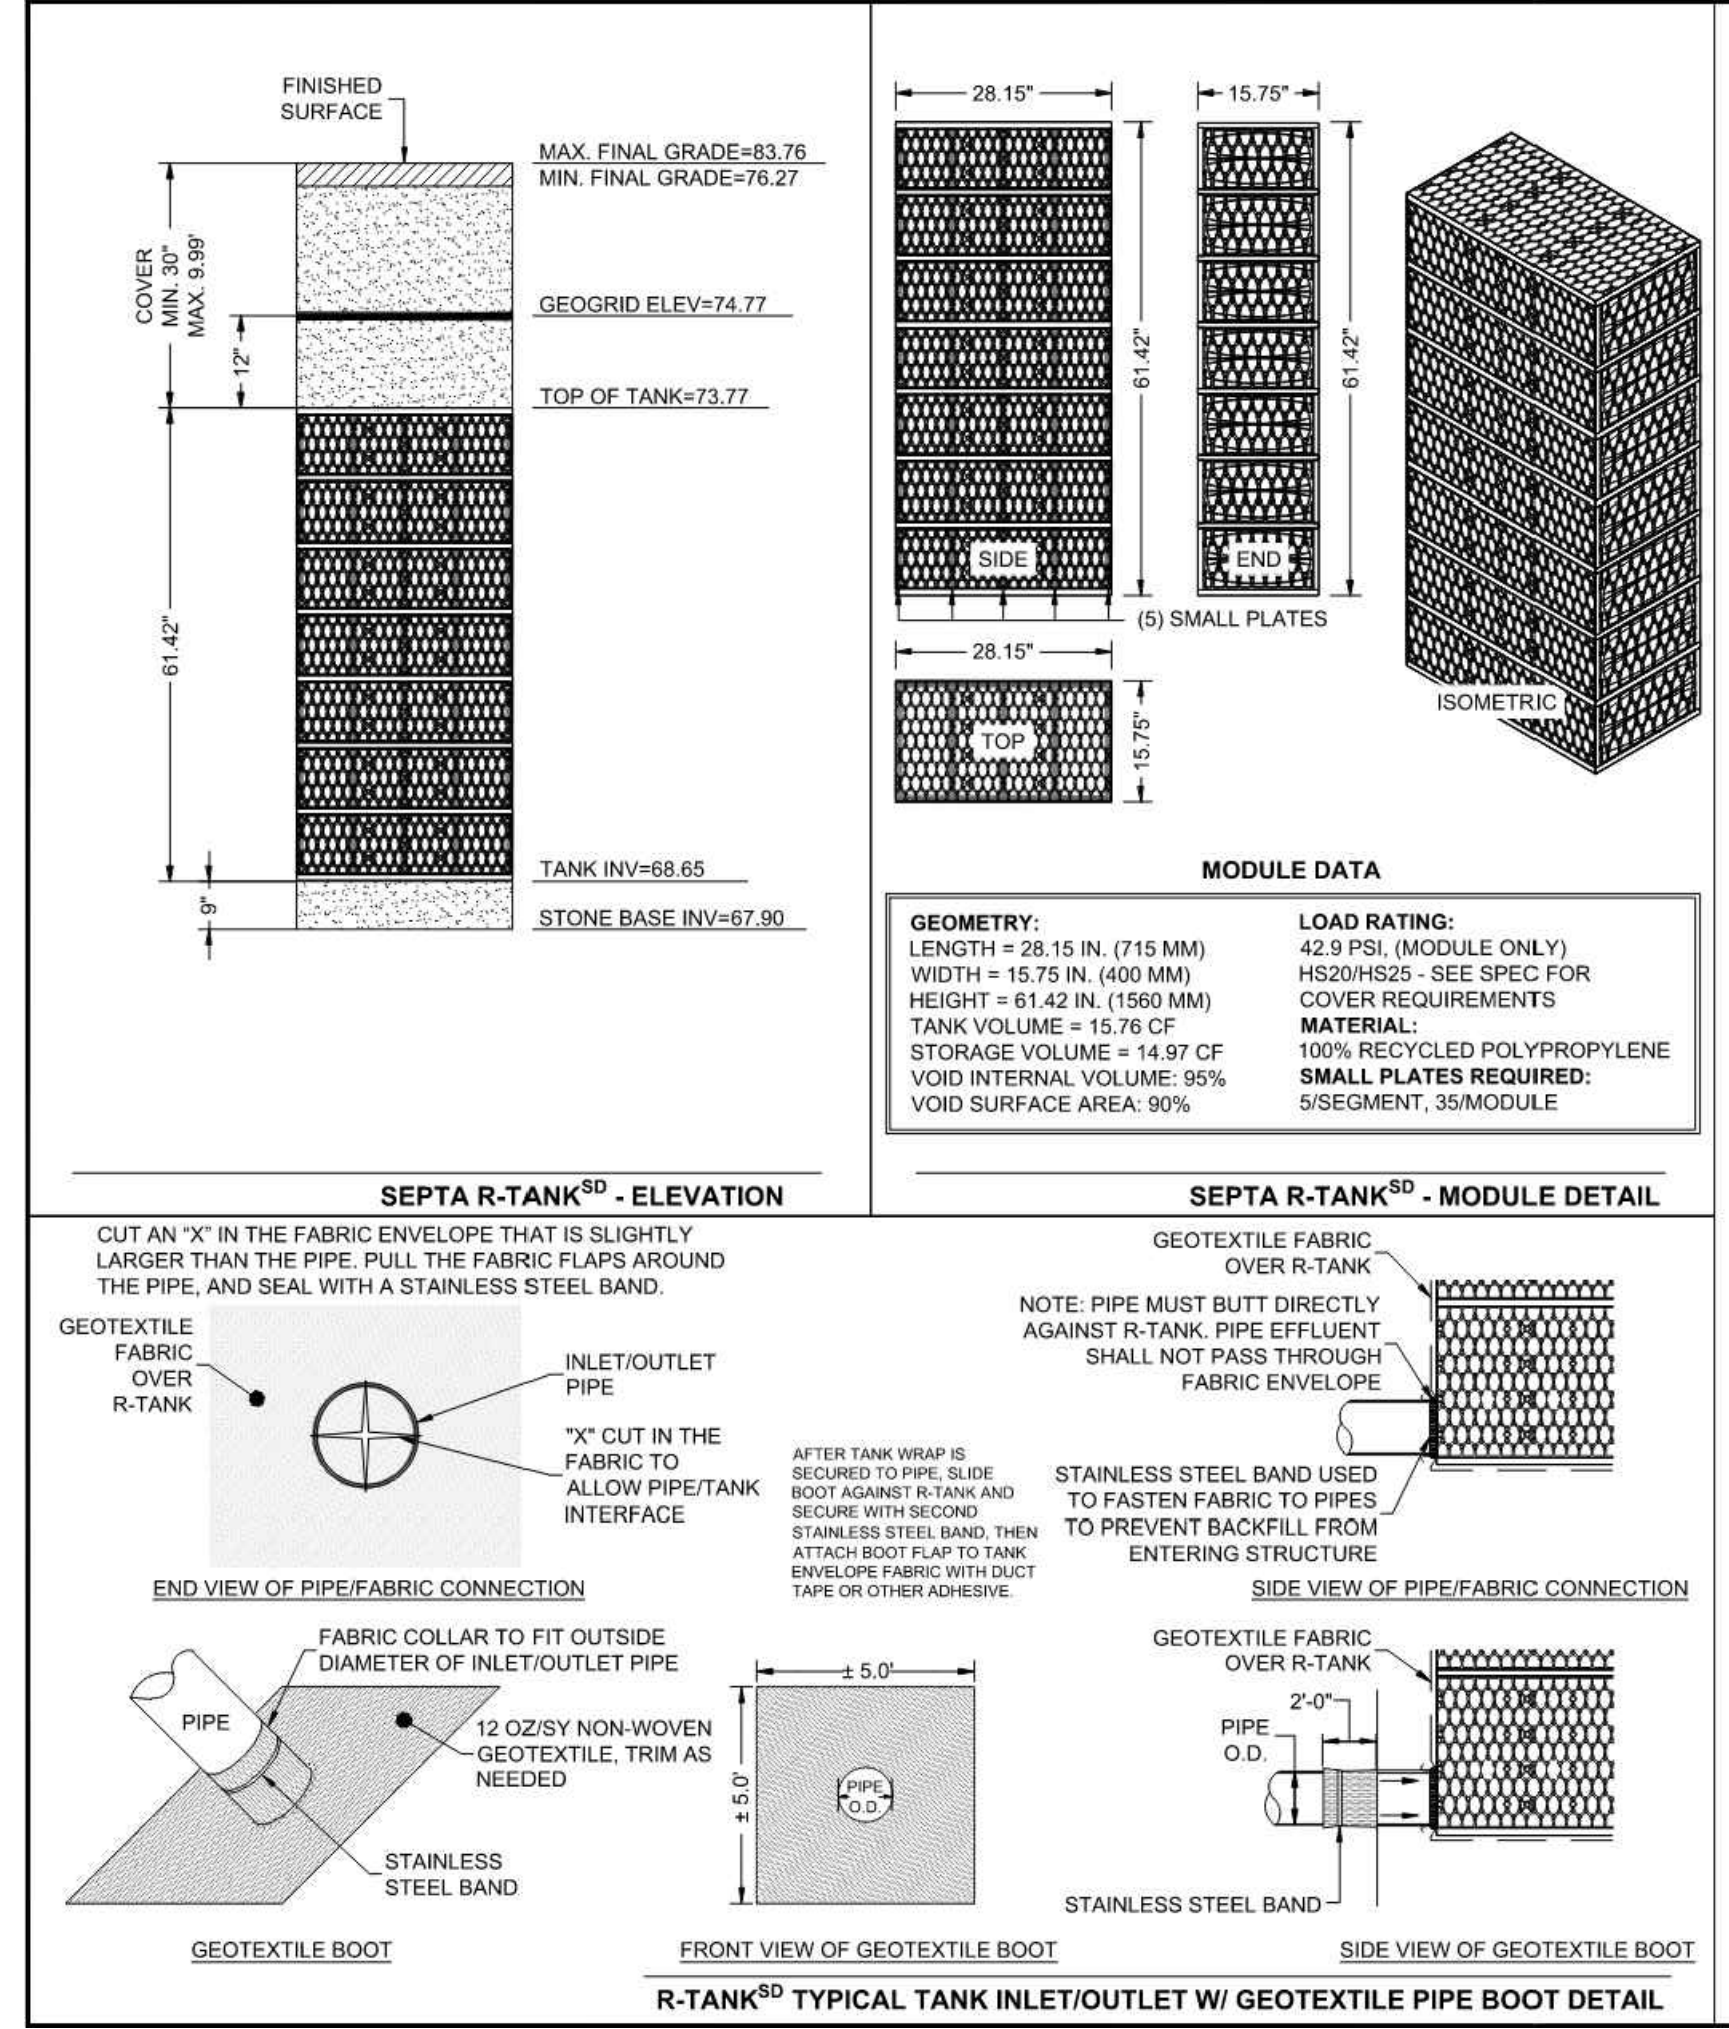

R-TANK <sup>RD</sup> QUANTITIES	
R-TANK <sup>RD</sup> MODULE TYPE	SEPTA
# OF SD SEPTA R-TANKS	6,829
# OF HD TRIPLE-MINI R-TANK ACCESS MODULES	20
TOTAL SYSTEM STORAGE	112,902 CF
R-TANK STORAGE VOLUME	102,518 CF
STONE STORAGE VOLUME (40% VOID RATIO)	10,384 CF
STONE BED FOOTPRINT	22,811 SF
STONE QUANTITY	1,806 CY
TENCATE MIRAFI 180N NON-WOVEN TANK WRAP	53,504 SF (5,945 SY)
30 MIL. GEOMEMBRANE LINER EXCAVATION WRAP	33,030 SF (3,670 SY)
TENCATE MIRAFI 1100N NON-WOVEN LINER PROTECTION	66,060 SF (7,340 SY)
TENCATE MIRAFI 180N NON-WOVEN TREAT. ROW WRAP	659 SF (73 SY)
TENCATE MIRAFI FW-402 WOVEN TREAT. ROW BASE FABRIC	388 SF (43 SY)
NAUE SECUGRID 30/30 GEOGRID	30,265 SF (3,363 SY)
12" MAINTENANCE PORTS	7
12" INSPECTION PORTS	2
12" PIPE BOOTS	2
24" PIPE BOOTS	2
TRASHGUARD PLUS UNITS (RECOMMENDED)	1
NOTE: STONE QUANTITY INCLUDES 12" OF COVER AND 9" OF BASE.	
NOTE: GEOTEXTILE / LINER QUANTITIES INCLUDE A 15% WASTE FACTOR.	

NOTE:  
 30 MIL. GEOMEMBRANE LINER SHALL BE ULTRAVIOLET (UV) LIGHT RESISTANT.





NOTES:  
 1. DEAD STORAGE VOLUME FROM ELEVATION 67.90 TO 68.40 = 4,562 CF  
 2. LIVE STORAGE VOLUME FROM ELEVATION 68.40 TO 74.27 = 112,902 CF  
 3. ONLY 3" OF BASE STONE INCLUDED IN LIVE STORAGE VOLUME.

**ACF WEST INC.**  
 GEOSYNTHETICS  
 PRODUCTS • SERVICES • SOLUTIONS  
 FOR ADDITIONAL INFORMATION PLEASE CONTACT:  
 ACF WEST, 1-800-423-4567, www.acfwest.com

**R-TANK<sup>RD</sup> SYSTEM DETAILS**  
 EAST TOWN CROSSING  
 PUYALLUP, WA  
 SITE DESIGNATION: R-TANK 2

EDG  
 02/21/2024  
 23-004WA

3 of 8

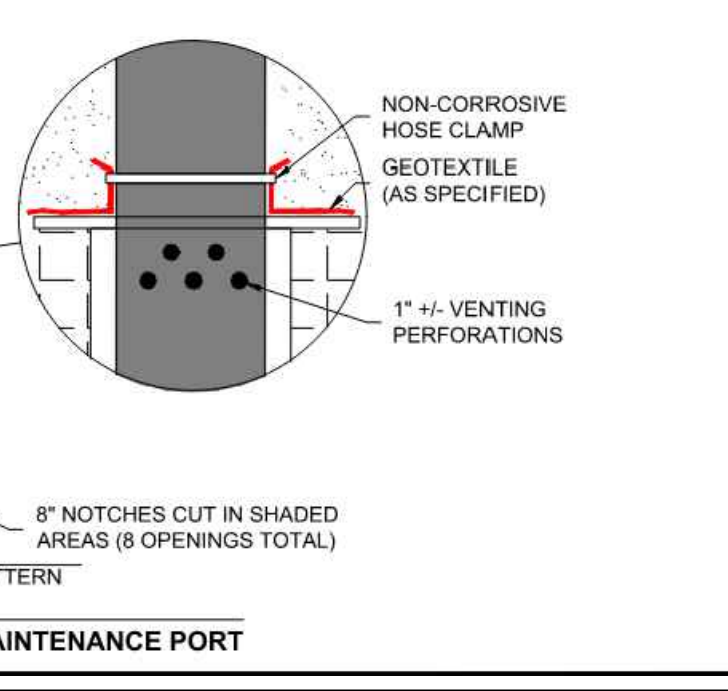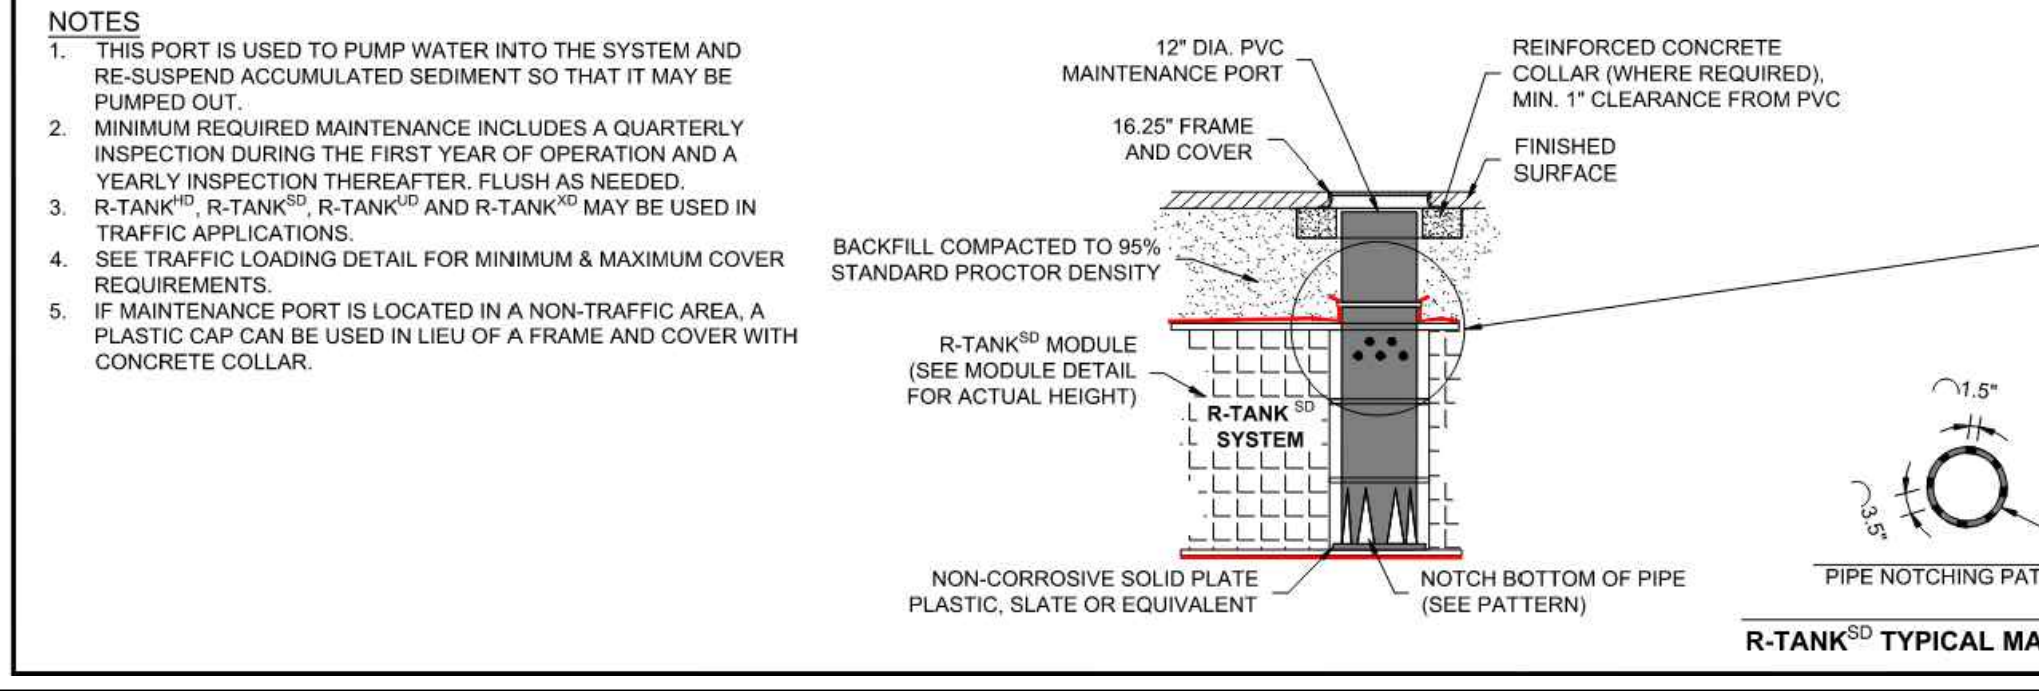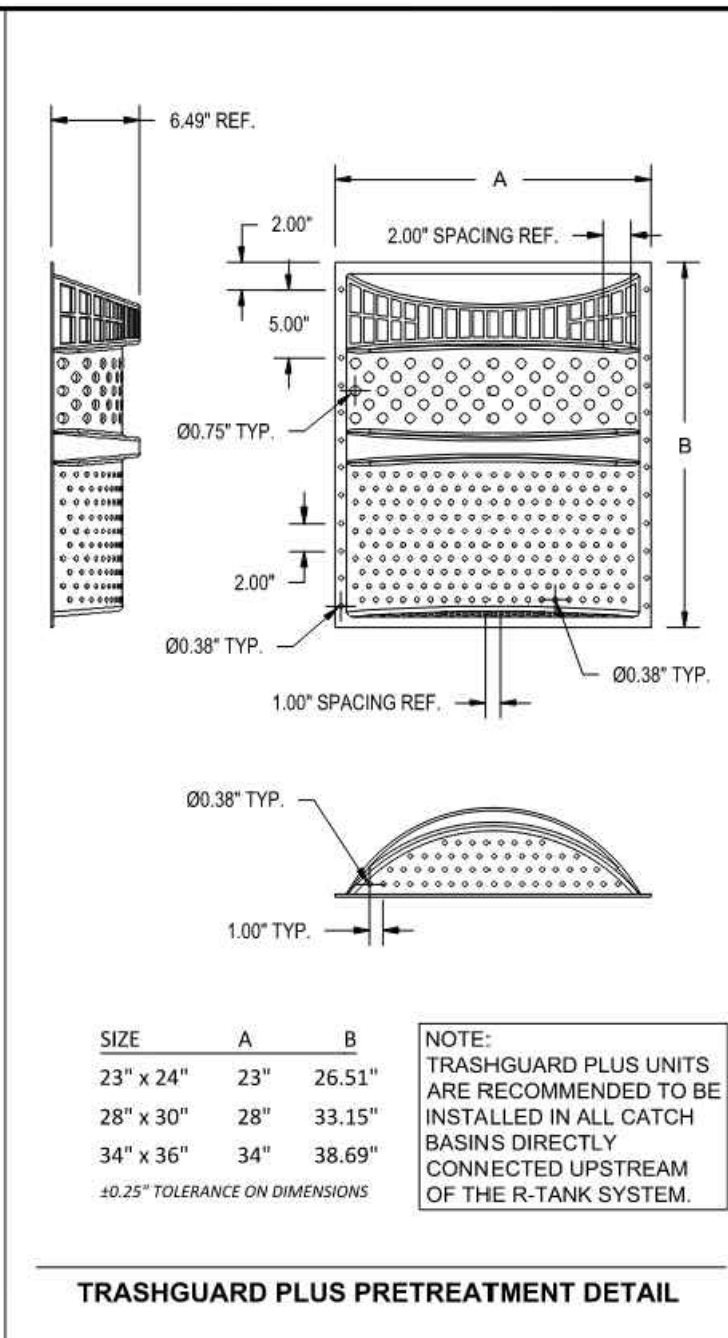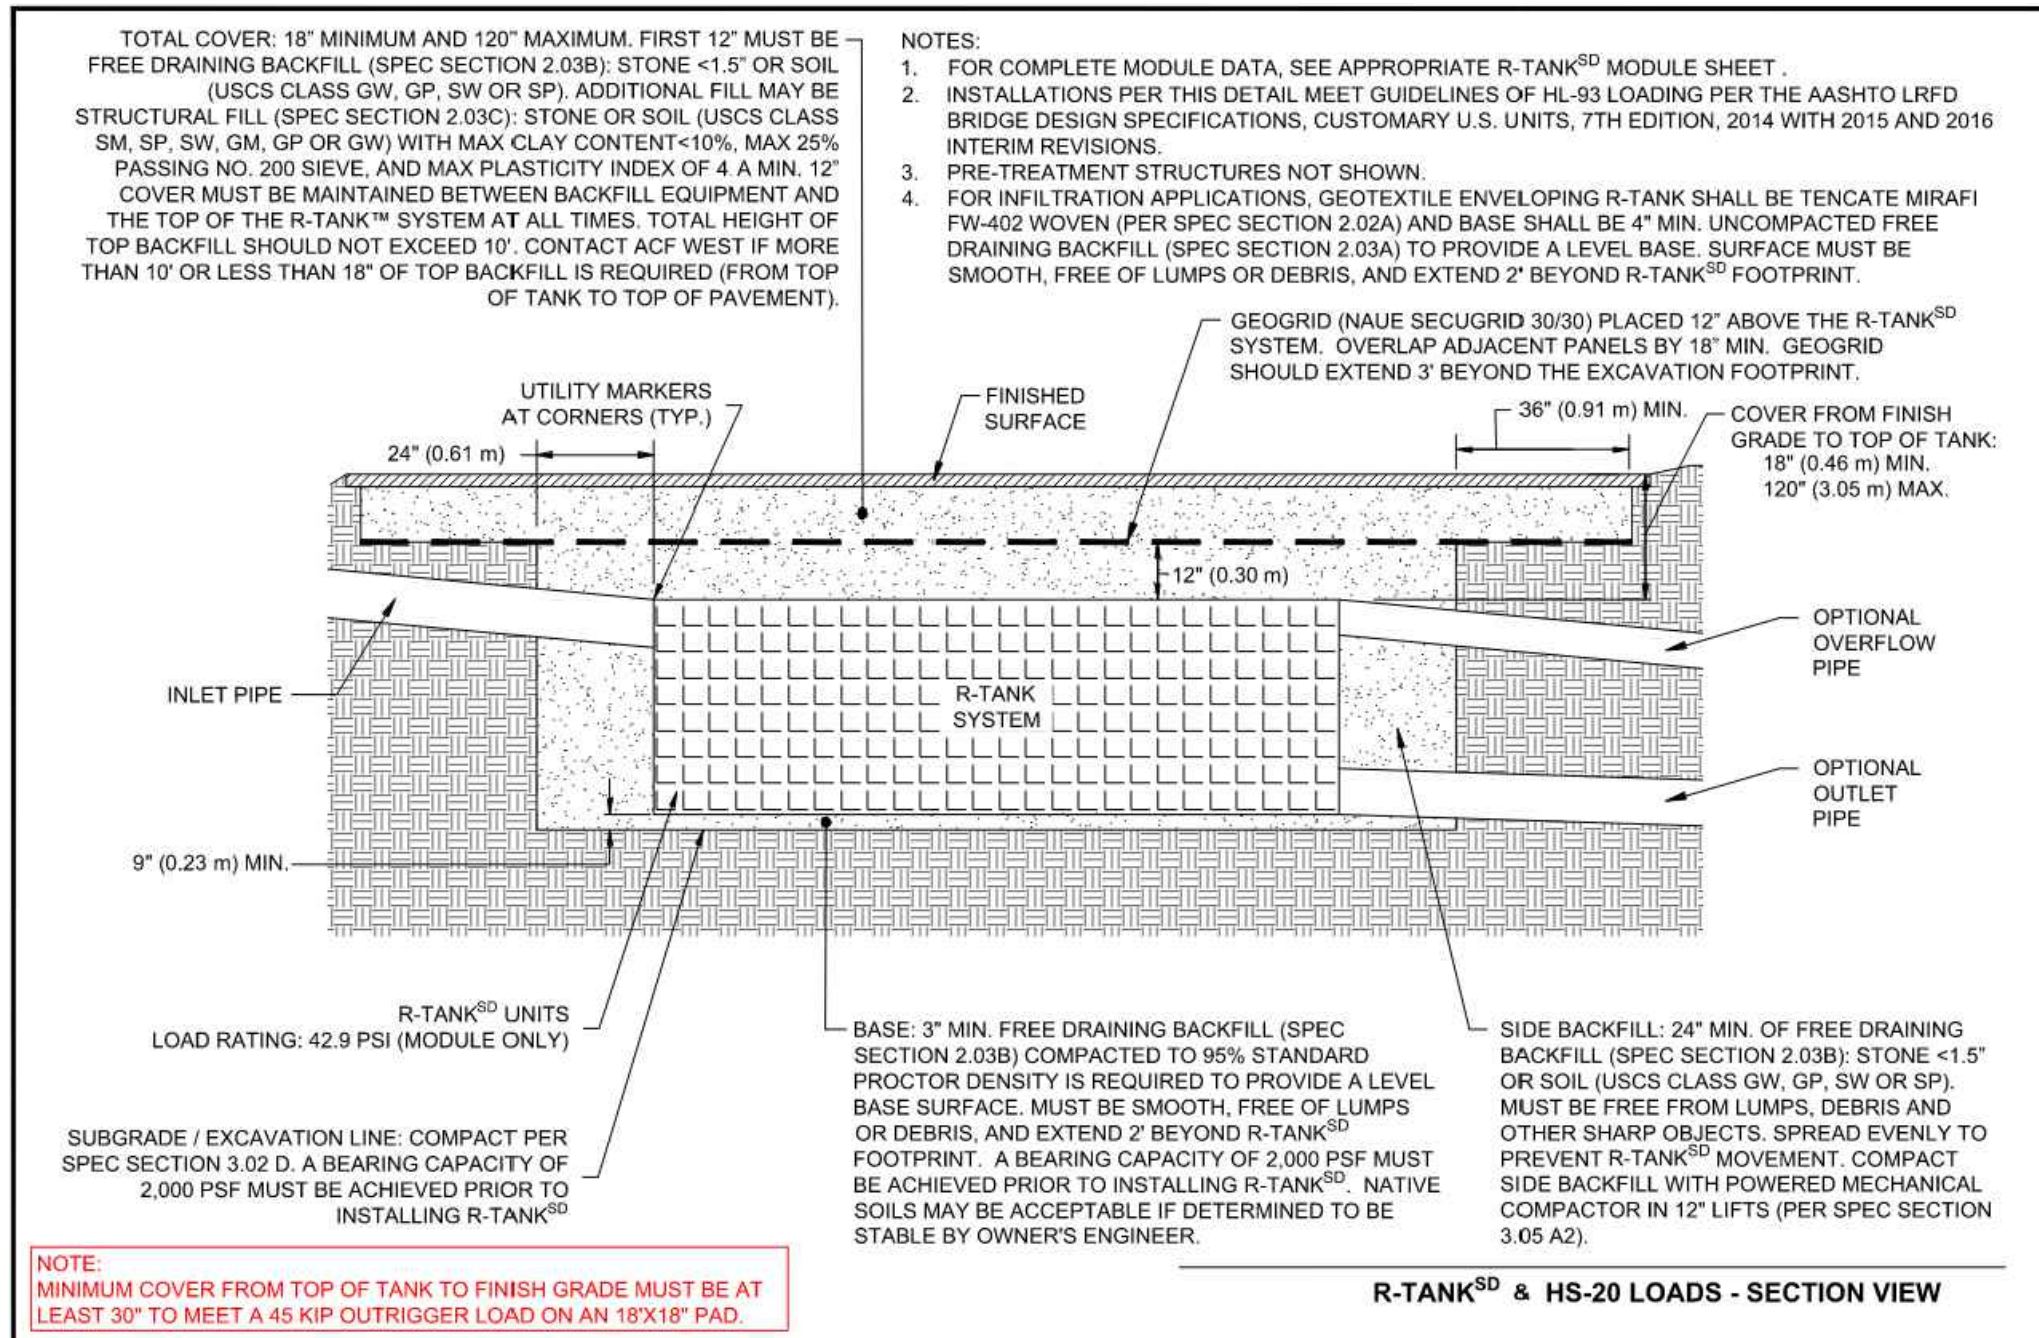

**ACF WEST INC.**  
 GEOSYNTHETICS  
 PRODUCTS • SERVICES • SOLUTIONS  
 FOR ADDITIONAL INFORMATION PLEASE CONTACT:  
 ACF WEST, 1-800-423-4567, www.acfwest.com

**R-TANK<sup>RD</sup> SYSTEM DETAILS**  
 EAST TOWN CROSSING  
 PUYALLUP, WA  
 SITE DESIGNATION: R-TANK 2

EDG  
 02/21/2024  
 23-004WA

4 of 8





# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.





Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT


GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
 PERMIT SUBMITTAL  
 05/17/2024

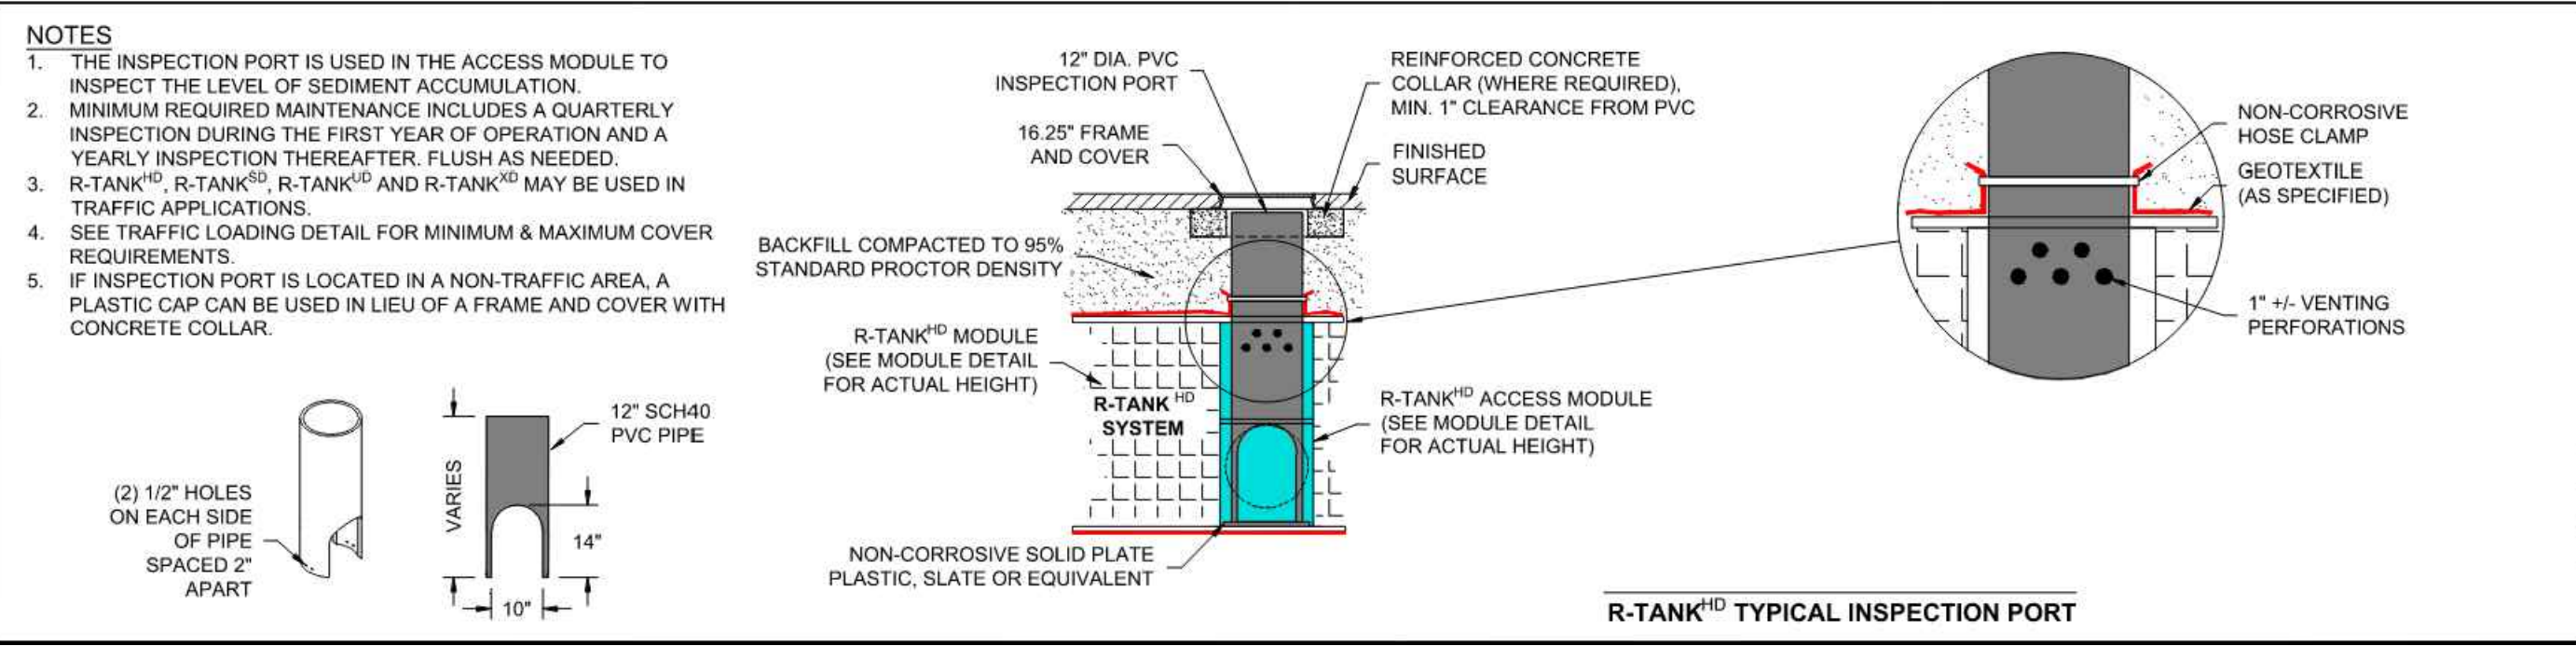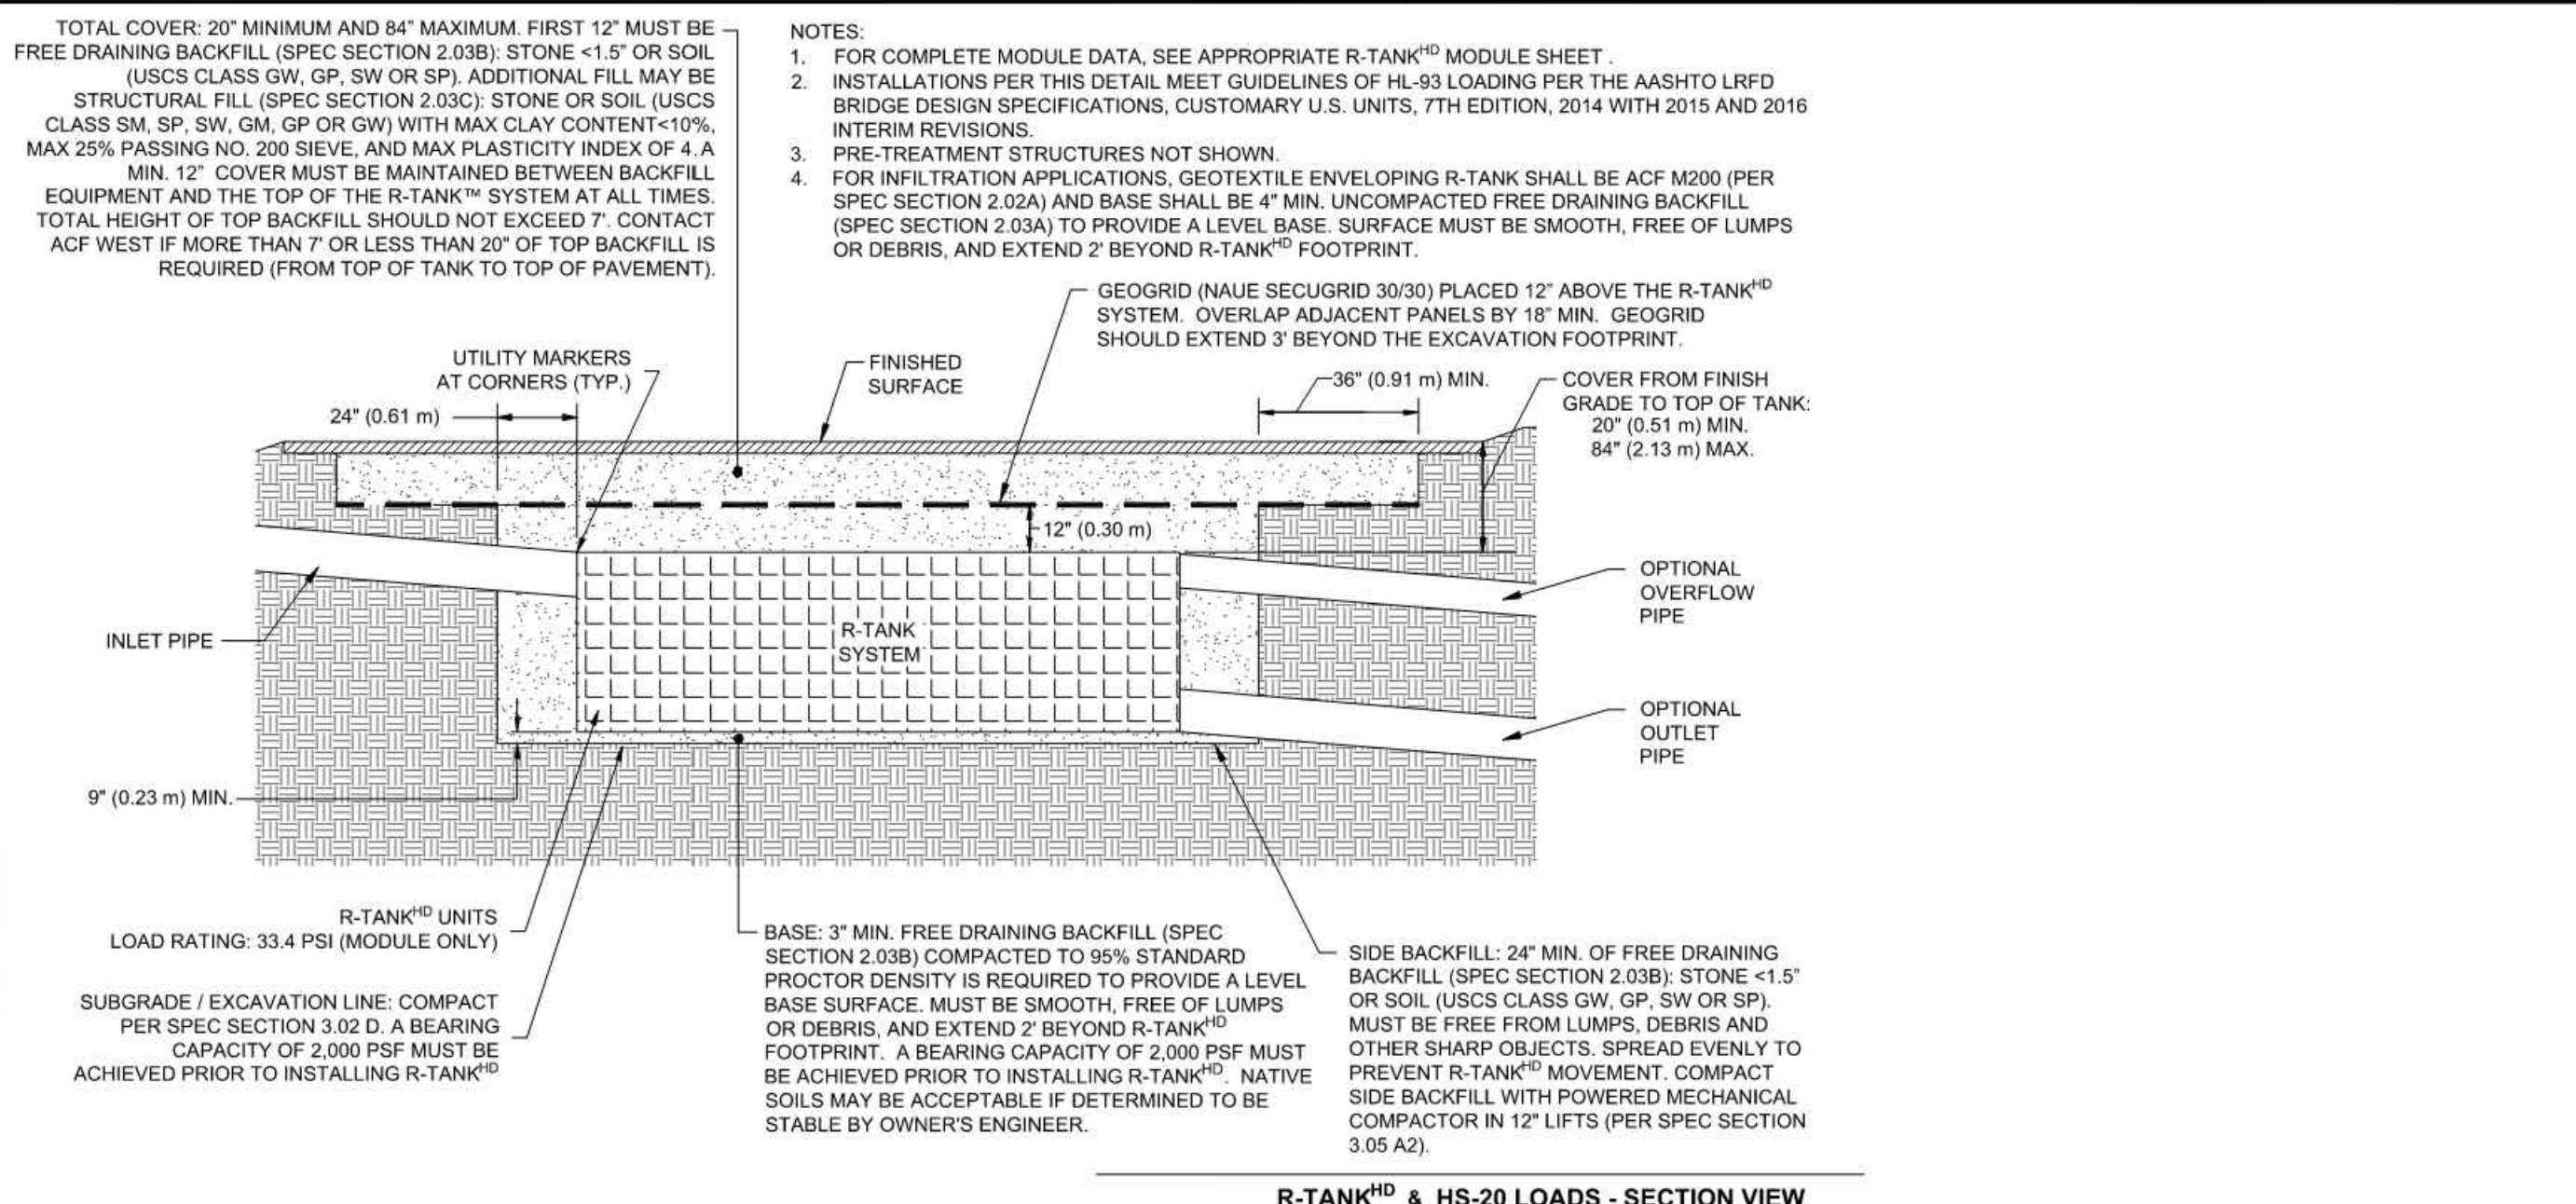

R-TANK<sup>HD</sup> SYSTEM DETAILS  
 EAST TOWN CROSSING  
 PUYALLUP, WA  
 SITE DESIGNATION: R-TANK 2  
 5 of 8

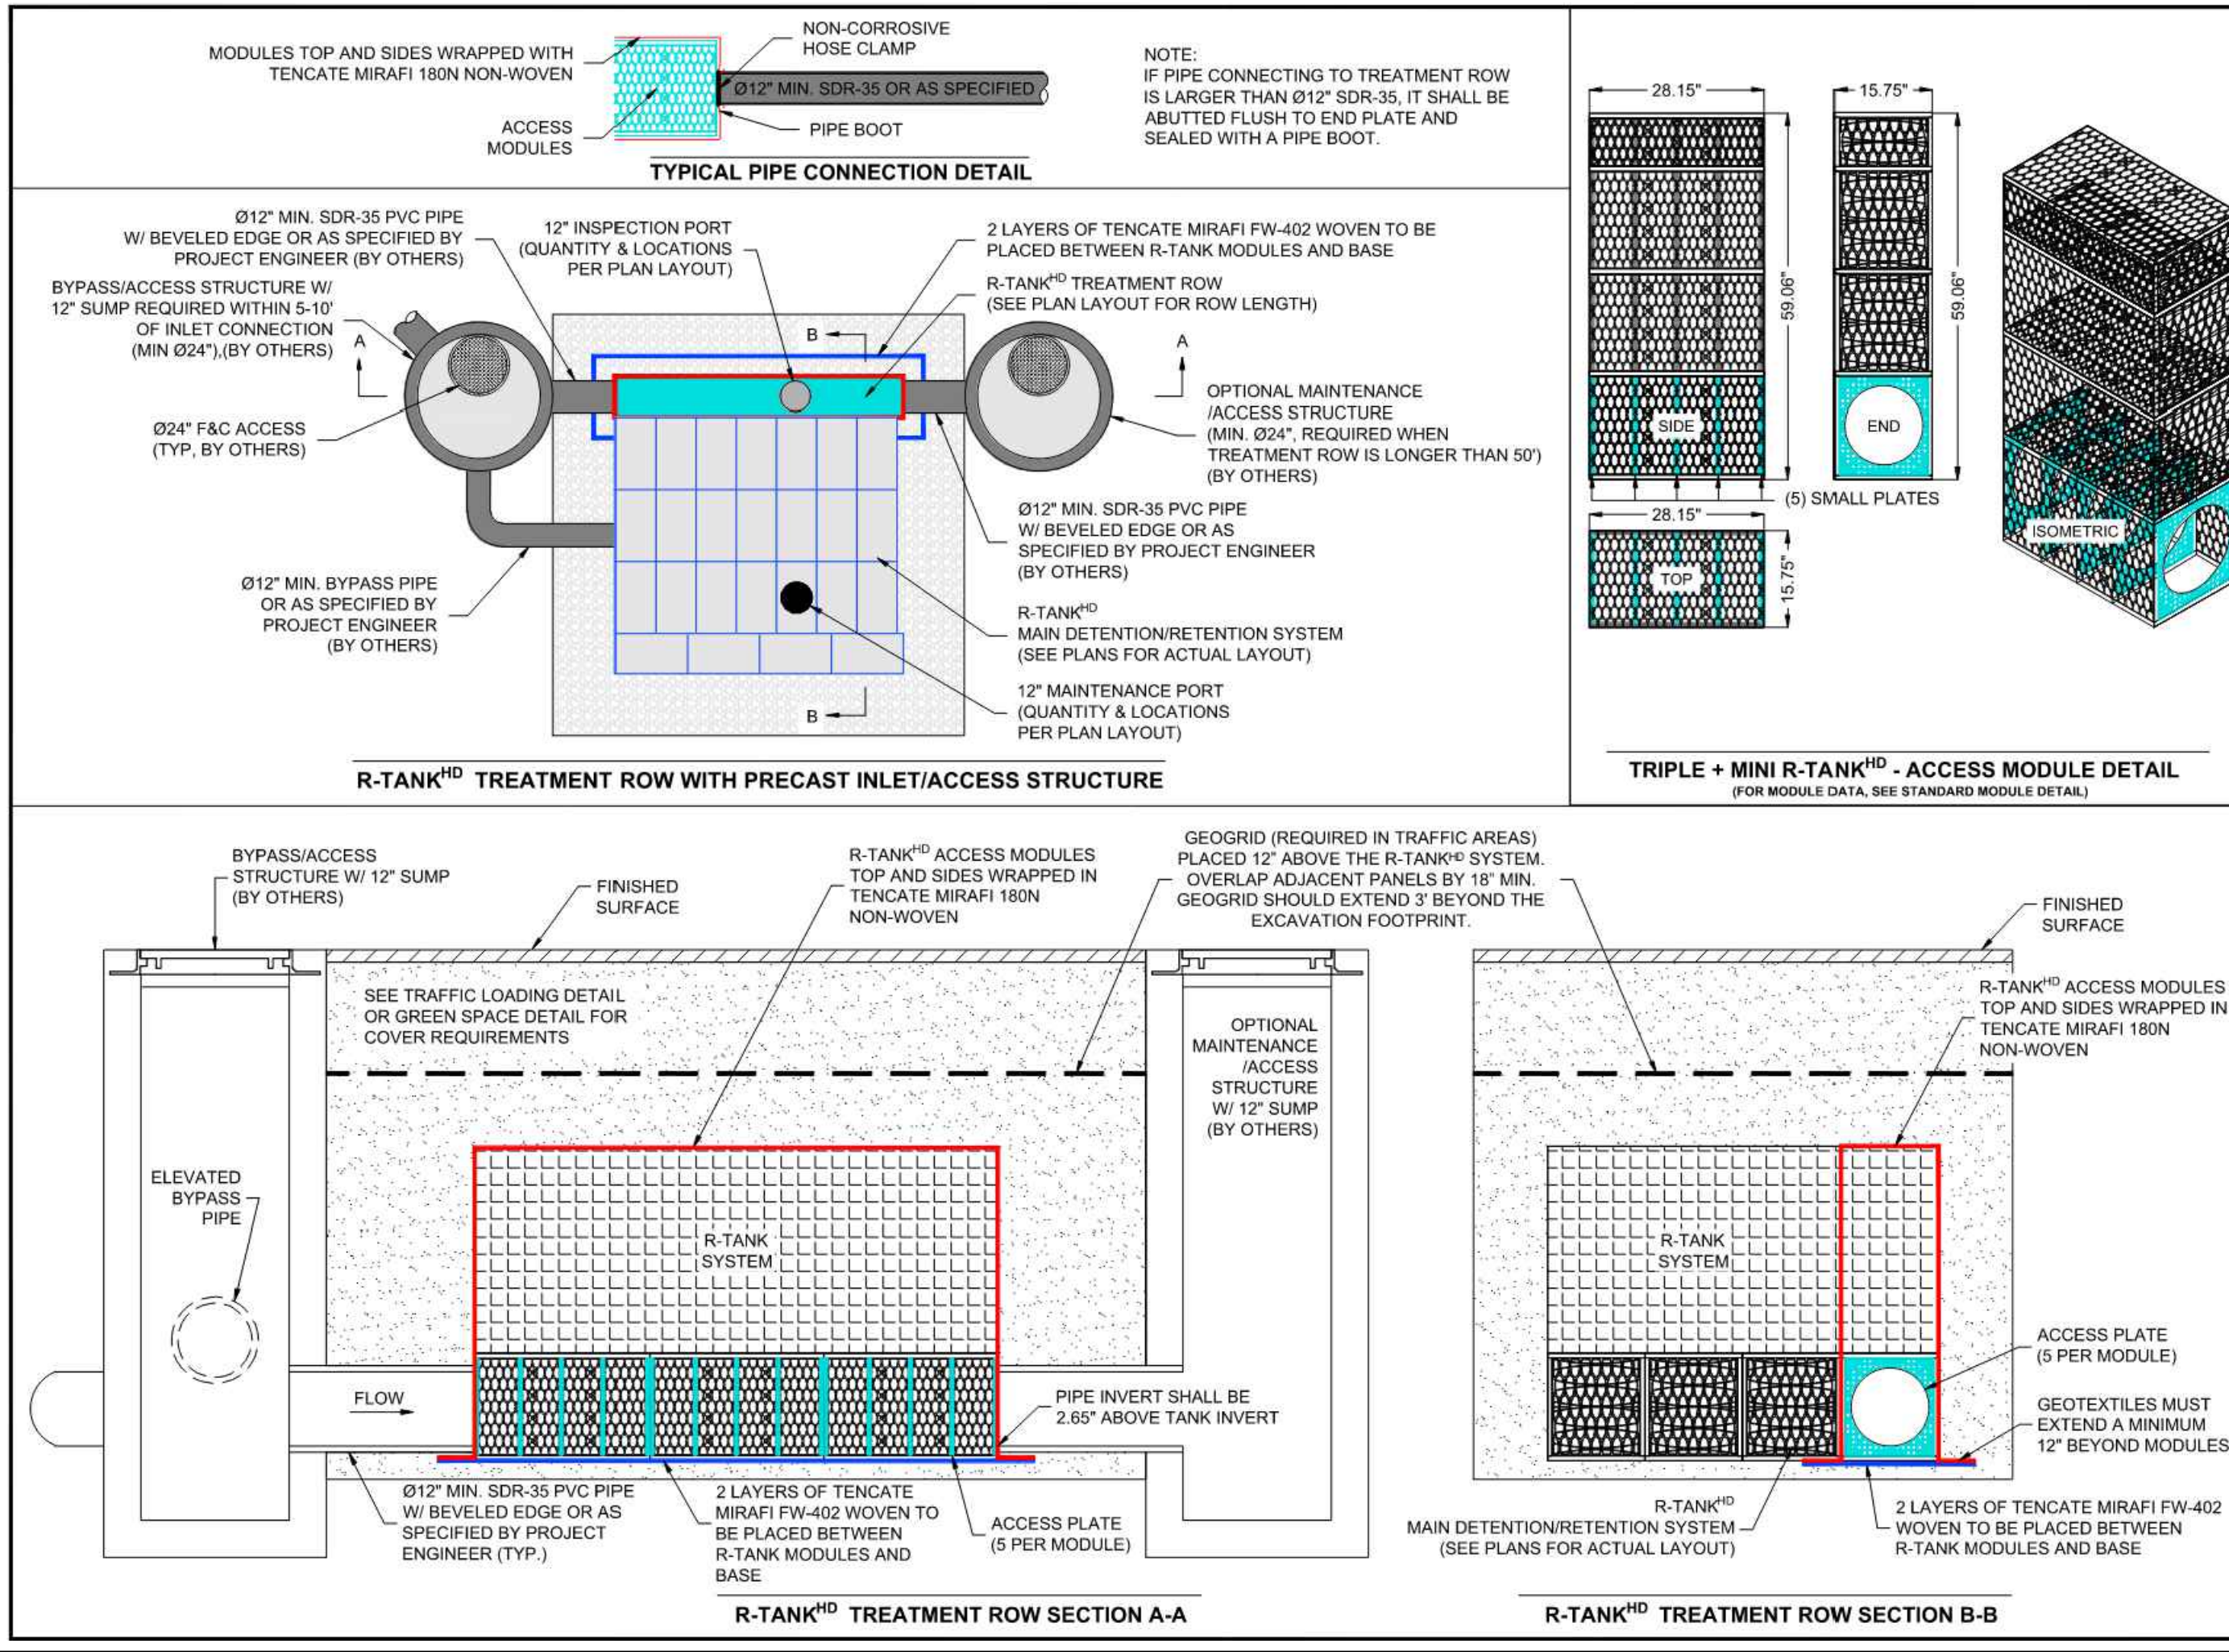

R-TANK<sup>HD</sup> TREATMENT ROW DETAILS  
 EAST TOWN CROSSING  
 PUYALLUP, WA  
 SITE DESIGNATION: R-TANK 2  
 6 of 8

NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE AN ENDORSEMENT OF THE PROJECT OR THE QUALITY OF THE WORK. THIS DOCUMENT IS TO BE USED ONLY FOR THE PROJECT ENTITLED IN THE TITLE BLOCK AND IS NOT TO BE USED FOR ANY OTHER PROJECT OR ADDITION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title:  
**R-TANK 2 NOTES AND DETAILS**

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C4.22**  
 29 of 53 Sheets





# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

**APPROVED**  
BY:   
CITY OF PUYALLUP  
DEVELOPMENT ENGINEERING  
DATE: 06/06/2024



Project Title:  
**EAST TOWN CROSSING PHASE 1**


Client:  
ASH DEVELOPMENT

GREG HELLE  
GREG.HELLE@ASHNW.COM

Project No.  
2230752


Issue Set & Date:  
**PERMIT SUBMITTAL**

05/17/2024

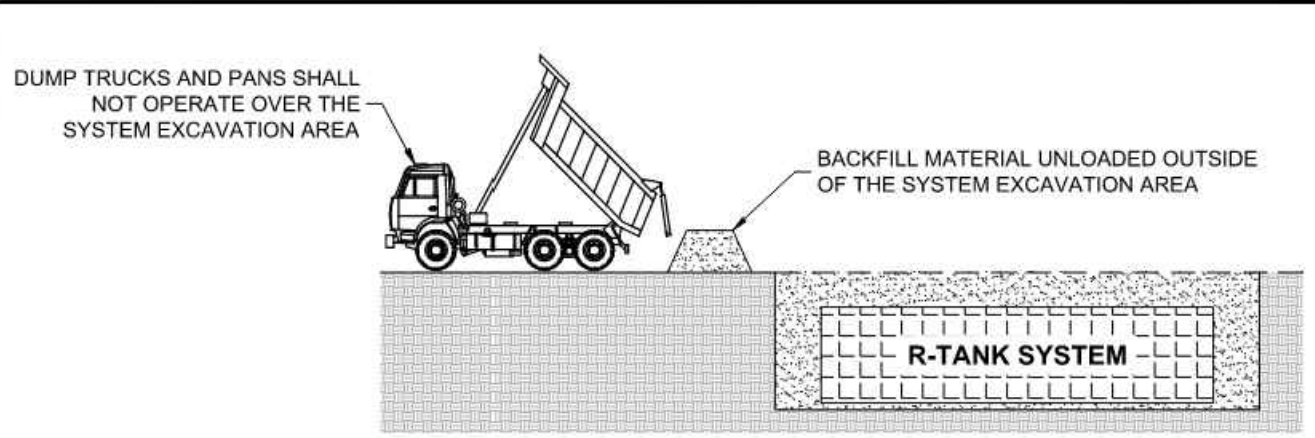

**NOTES:**  
1. FOLLOWING PLACEMENT OF SIDE BACKFILL, A UNIFORM 12" LIFT OF THE FREELY DRAINING MATERIAL (SPEC SECTION 2.03 B2) SHALL BE PLACED OVER THE R-TANK AND LIGHTLY COMPACTED USING A WALK-BEHIND TRENCH ROLLER. ALTERNATELY, A ROLLER (MAXIMUM GROSS VEHICLE WEIGHT OF 6 TONS) MAY BE USED. ROLLER MUST REMAIN IN STATIC MODE UNTIL A MINIMUM OF 24" OF COVER HAS BEEN PLACED OVER THE MODULES. SHEEP FOOT ROLLERS SHOULD NOT BE USED. **SPEC SECTION 3.05 A5**  
2. ONLY LOW PRESSURE TIRE OR TRACK VEHICLES (LESS THAN 7 PSI AND OPERATING WEIGHT OF LESS THAN 20,000 LBS) SHALL BE OPERATED OVER THE R-TANK SYSTEM DURING CONSTRUCTION. **SPEC SECTION 3.05 A5**  
3. DUMP TRUCKS AND PANS SHALL NOT BE OPERATED WITHIN THE R-TANK SYSTEM AT ANY TIME. WHERE NECESSARY, THE HEAVY EQUIPMENT SHOULD UNLOAD IN AN AREA ADJACENT TO THE R-TANK SYSTEM AND THE MATERIAL SHOULD BE MOVED OVER THE SYSTEM WITH TRACKED EQUIPMENT. **SPEC SECTION 3.05 A5**  
4. ENSURE THAT ALL UNRELATED CONSTRUCTION TRAFFIC IS KEPT AWAY FROM THE LIMITS OF EXCAVATION UNTIL THE PROJECT IS COMPLETE AND FINAL SURFACE MATERIALS ARE IN PLACE. NO NON-INSTALLATION RELATED LOADING SHOULD BE ALLOWED OVER THE R-TANK SYSTEM UNTIL THE FINAL DESIGN SECTION HAS BEEN CONSTRUCTED (INCLUDING PAVEMENT). **SPEC SECTION 3.05 B**  
5. SEE R-TANK INSTALLATION GUIDE OR CONTACT YOUR LOCAL ACF WEST REPRESENTATIVE FOR ADDITIONAL INFORMATION.

DUMP TRUCK DETAIL (SEE NOTE 3)

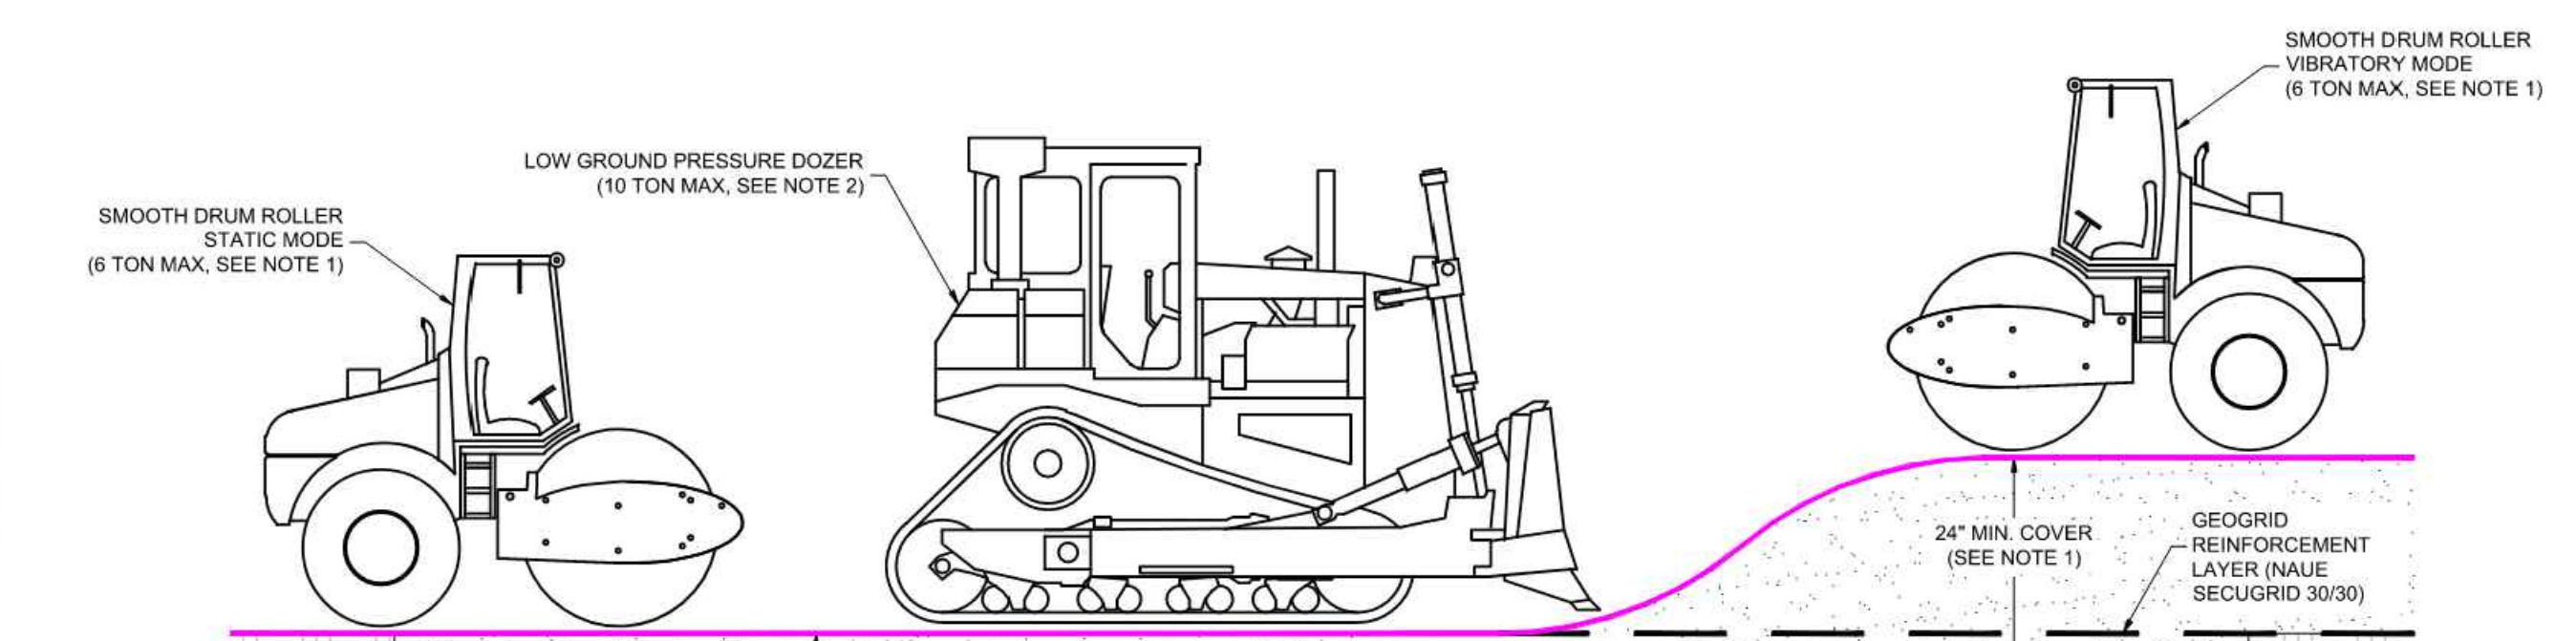

CONSTRUCTION EQUIPMENT COVER DETAIL - VEHICULAR TRAFFIC

R-TANK® OR R-TANK® UNITS  
HD: LOAD RATING: 33.4 PSI (MODULE ONLY)  
SD: LOAD RATING: 42.9 PSI (MODULE ONLY)

SUBGRADE / EXCAVATION LINE: COMPACT PER SPEC SECTION 3.02 D. A BEARING CAPACITY OF 2,000 PSF MUST BE ACHIEVED PRIOR TO INSTALLING R-TANK® OR R-TANK®

**ACF WEST, INC.**  
GEOTECHNICAL CONSULTANTS  
FOR ADDITIONAL INFORMATION PLEASE CONTACT:  
ACF WEST, 1800 4242 45ST, WWW.ACFWEST.COM

**R-TANK® CONSTRUCTION EQUIPMENT COVER DETAIL**  
EAST TOWN CROSSING  
PUYALLUP, WA  
SITE DESIGNATION: R-TANK 2

EDD  
DATE: 02/21/2024  
PROJECT NUMBER: 23-004WA  
SHEET NO: 7 of 8

### R-TANK SPECIFICATION

**PART 1 - GENERAL**  
1.01 RELATED DOCUMENTS  
A. Drawings, technical specification and general provisions of the Contract as modified herein apply to this section.  
1.02 DESCRIPTION OF WORK INCLUDED  
A. Provide excavation and base preparation per geotechnical engineer's recommendations and/or as shown on the design drawings, to provide adequate support for project design loads and safety from excavation induced collapse. Excavations shall be in accordance with the owner's and OSHA requirements.  
B. Provide and install R-Tank® (R-Tank®; R-Tank®SD; or R-Tank®UD) system (hereinafter called R-Tank) and all related products including fill materials, geotextiles, geogrids, inlet and outlet pipe with connectors per the manufacturer's installation guidelines provided in the section.  
C. Provide and construct the cover of the R-Tank system including: stone backfill, structural fill cover, and pavement section as specified.  
D. Protect R-Tank system from construction traffic after installation until completion of all construction activity in the installation area.  
1.03 QUALITY CONTROL  
A. All materials shall be manufactured in ISO certified facilities.  
B. Installation Contractor shall demonstrate the following experience:  
1. A minimum of three R-Tank or equivalent projects completed within 2 years;  
2. A minimum of 25,000 cubic feet of storage volume completed within 2 years;  
C. Contractor experience requirement may be waived if the manufacturer's representative provides on-site training and review during construction.  
D. Installation Personnel: Performed only by skilled workers with satisfactory record of performance on bulk earthworks, pipe, chamber, or precast/field construction projects of comparable size and quality.  
E. Contractor must have manufacturer's representative available for site review if requested by Owner.  
1.04 SUBMITTALS  
A. Submit proposed R-Tank layout drawings. Drawings shall include typical section details as well as the required base elevation of stone and tanks, minimum cover requirements and tank configuration.  
B. Submit manufacturer's product data, including compressive strength and unit weight.  
C. Submit manufacturer's installation instructions.  
D. Submit R-Tank samples for review. Retrieved and accepted samples will be returned to the Contractor.  
E. Submit material certificates for geotextiles, geogrids, base course and backfill materials.  
F. Submit required experience and personnel requirements as specified in Section 1.03.  
G. Submit required product substitution to this specification must be submitted for review and approval prior to bid opening. Review package should include third party reviewed performance data that meets or exceeds criteria in Table 2.01 B.  
1.05 DELIVERY, STORAGE, AND HANDLING  
A. Protect R-Tank and other materials from damage during delivery, and store UV sensitive materials under tarp to protect from sunlight when time from delivery to installation exceeds two weeks. Storage of materials should be on smooth surfaces, free from dirt, mud and debris.  
B. Handling is to be performed with equipment appropriate to the materials and site conditions, and may include hand, handcart, forklift, palletforks, etc.  
C. Cold weather:  
1. Care must be taken when handling plastics when air temperature is 40 degrees or below as plastics become brittle.  
2. Do not use frozen materials or materials mixed or coated with ice or frost.  
3. Do not build on frozen ground or wet, saturated or muddy subgrade.  
1.06 PREINSTALLATION CONFERENCE  
A. Prior to the start of the installation, a preinstallation conference shall occur with the representatives from the design team, the general contractor, the excavation contractor, the R-Tank installation contractor, and the manufacturer's representative.  
1.07 PROJECT CONDITIONS  
A. Coordinate installation for the R-Tank system with other on-site activities to eliminate all non-installation related construction traffic over the completed R-Tank system. No loads heavier than the design loads shall be allowed over the system, and in no case shall loads higher than a standard ASHTO H20 (or H25, depending on design criteria) load be allowed on the system at any time.  
B. Protect adjacent work from damage during R-Tank system installation.  
C. All pre-treatment systems to remove debris and heavy sediments must be in place and functional prior to operation of the R-Tank system. Additional pre-treatment measures may be needed if unit is operational during construction due to increased sediment loads.  
D. Contractor is responsible for any damage to the system during construction.

2.04 OTHER MATERIALS  
A. Utility Marker: Install metallic tape at corners of R-Tank system to mark the area for future utility detection.  
**PART 3 - EXECUTION**  
3.01 ASSEMBLY OF R-TANK UNITS  
A. Assembly of modules shall be performed in accordance with the R-Tank Installation Manual, Section 2.  
3.02 LAYOUT AND EXCAVATION  
A. Installer shall stake out, excavate, and prepare the subgrade area to the required plan grades and dimensions, ensuring that the excavation is at least 2 feet greater than R-Tank dimensions in each direction allowing for installation of geotextile liner fabric, R-Tank modules, and free draining backfill materials.  
B. Excavations must be prepared with OSHA approved excavated sides and sufficient working space.  
C. Protect partially excavated installation against damage from other construction traffic by establishing a perimeter with high visibility construction tape, fencing, barricades, or other means and construction to complete.  
D. Base of the excavation shall be uniform, level, and free of lumps or debris and soft or yielding subgrade areas. A minimum 2,000 pounds per square foot bearing capacity is required.  
E. Infiltration Applications: Backfill materials shall be prepared in accordance with the contract documents. Compaction of aggregate should not be performed in infiltration applications.  
F. Unsuitable Soils or Conditions: All conditions about the base of the excavation shall be directed to the owner's engineer, who will approve the subgrade conditions prior to placement of stone. The owner's engineer shall determine the required bearing capacity of the R-Tank subgrade; however in no case shall a bearing capacity of less than 2,000 pounds per square foot be provided.  
G. Unsuitable soils are encountered at the subgrade, or if the subgrade is pumping or appears excessively soft, repair the area in accordance with contract documents and/or as directed by the owner's engineer.  
H. If indications of the water table are observed during excavation, the engineer shall be contacted to provide recommendations.  
I. Do not install installation of the R-Tank system until satisfactory subgrade conditions are corrected and the subgrade conditions are accepted by the owner's engineer.  
3.03 PREPARATION OF BASE  
A. Place a thin layer (2") unless otherwise specified of bedding material (Section 2.03 A), over the subgrade to establish a level working platform for the R-Tank modules. Level to within 1/2" (+/-) or as shown on the plans. Native subgrade soils or other materials may be used if determined to meet the requirements of 2.03 A and are accepted by the owner's engineer.  
B. Standard Applications: Static roll or otherwise compact bedding materials until they are firm and unyielding.  
C. Infiltration Applications: Bedding materials shall be prepared in accordance with the contract documents.  
D. Outline the footprint of the R-Tank system on the excavation floor using string line to ensure a 2' perimeter is available around the R-Tank system for proper installation and compaction of backfill.  
3.04 INSTALLATION OF THE R-TANKS  
A. Where a geotextile liner is specified on the stone base, cut strips to length and install in excavation, removing wrinkles so material lays flat. Overlap geotextile a minimum 12" or as recommended by manufacturer. Use tape, special adhesives, sandbags or other ballast to secure overlaps. All geotextiles can be damaged by extreme heat, smoking is not permissible on or near the geotextile, and any other penetrations of the geotextile (and optional liner). These connections should be installed flush (flushed) to the R-Tank and the geotextile fabric shall be cut to enable hydraulic continuity between the connections and the R-Tank units. These connections shall be secured using pipe boots with stainless steel clip clamp. Support pipe in inches during backfill operations to prevent pipe from settling and causing the geotextile, impervious liner if specified or open. Connecting pipe at 90 degree angles facilitates construction, unless otherwise specified. Ensure end of pipe is installed snug against R-Tank system.  
B. For LD, HD, and SD installations, the large side plate of the tank should be placed on the perimeter of the system. This will typically require that the two ends of the tank area will have a row of tanks placed perpendicular to all other tanks. If this is not shown in the construction drawings, it is a simple field adjustment that will have minimal effect on the overall system footprint. Refer to R-Tank installation Guide for more details.  
C. For LD installations, there is no perpendicular and no required.  
D. Prep the R-Tank top and sides in specified geotextile. Cut edges of geotextile so that it will cover the sides and top, encapsulating the entire system to prevent backfill entry into the system. Overlap geotextile 12" or as recommended by manufacturer. Take great care to avoid damage to geotextile (and, if specified, impervious liner) during placement.  
E. Identify locations of free, outlet and any other penetrations of the geotextile (and optional liner). These connections should be installed flush (flushed) to the R-Tank and the geotextile fabric shall be cut to enable hydraulic continuity between the connections and the R-Tank units. These connections shall be secured using pipe boots with stainless steel clip clamp. Support pipe in inches during backfill operations to prevent pipe from settling and causing the geotextile, impervious liner if specified or open. Connecting pipe at 90 degree angles facilitates construction, unless otherwise specified. Ensure end of pipe is installed snug against R-Tank system.  
F. Infiltration Applications: Install and maintain vents at locations noted on plans. At a minimum one maintenance port for every 2,500 square feet. Install all ports as noted in the R-Tank Installation Guide. If required, install ventilation pipes and vents as specified on drawings to provide ventilation for proper hydraulic performance. The number of pipes and vents will depend on the size of the system. Vents are often installed using a 90 degree elbow with PVC pipe into a landscaped area with 'U' bend or venting ball to inhibit the ingress of debris. A ground level concrete or steel cover can be used.  
3.05 BACKFILLING OF THE R-TANK UNITS  
A. Backfill and fill with recommended materials as follows:  
1. Place freely draining backfill materials (Section 2.03 B) about the perimeter in lifts with a maximum thickness of 12". Each lift shall be placed around the entire perimeter such that each lift is no more than 24" higher than the side backfill along any other location on the perimeter of the R-Tank system. No fill shall be placed over top of tanks until the side backfill has been completed.  
2. Each lift shall be compacted at the specified moisture content to a minimum of 95% of the Standard Proctor Density until no further densification is observed (for self-compacting stone materials). The side lifts must be compacted with walk behind compaction equipment. Even when "self-compacting" backfill materials are selected, a walk behind vibratory compactor must be used.  
3. Take care to ensure that the compaction process does not allow the machinery to come into contact with the modules due to the potential for damage to the geotextile and R-Tank units.  
4. No compaction equipment is permissible to operate directly on the R-Tank modules.  
5. Top Backfill: Only low pressure track vehicle shall be operated over the R-Tank system during construction. Dump Trucks and Pans shall not be operated within the R-Tank system footprint at any time. Heavy equipment should unload in an area adjacent to the R-Tank system and the material should be moved over the system using tracked equipment with an operating weight of less than 10 tons.  
a. Typical Applications: Install a 12" (or as shown on plans) lift of freely draining material (Section 2.03 B) over the R-Tank Units, maintaining 12" between equipment tracks and R-Tank System. Lightly compact using a walk-behind trench roller. Alternatively, a roller (maximum gross vehicle weight of 6 tons) may be used. Roller must remain in static mode a minimum of 24" of cover has been placed over the modules. Sheep foot rollers should not be used.  
b. Shallow Applications: (+1' total cover) install top backfill in accordance with plans.  
6. Following placement and compaction of the initial cover, subsequent lifts of structural fill (Section 2.03 C) shall be placed at the specified moisture content and compacted to a minimum of 95% of the Standard Proctor Density and shall cover the entire footprint of the R-Tank system. During placement of fill above the system, unless systems specified, a uniform elevation of fill shall be maintained to within 1/2" across the footprint of the R-Tank system. Do not exceed maximum cover depths listed in Table 2.01 B.  
B. Place additional layers of geotextile and/or geogrid at elevations as specified in the design details. Each layer of geotextile/ reinforcement placed above the R-Tank system shall extend a minimum of 3 feet beyond the limits of the excavation wall.  
C. Ensure that all unrelated construction traffic is kept away from the limits of excavation until the project is complete and final surface materials are in place. No non-installation related loading should be allowed over the R-Tank system until the final design section has been constructed (including pavement).  
D. Place surfacing materials, such as groundcover (no large trees), or paving materials over the structure with care to avoid displacement of cover fill and damage to surrounding areas.  
E. Backfill depth over R-Tank system shall be within the limitations shown in the table in Section 2.01 B. If the total backfill depth does not comply with this table, contact engineer or manufacturer's representative for assistance.  
3.06 MAINTENANCE REQUIREMENTS  
A. Routine maintenance effort is required to ensure proper performance of the R-Tank system. The Maintenance program should be based on pre-treatment systems. Ensuring these structures are clean and functioning properly will reduce the risk of contamination of the R-Tank system and abatement released from the site. The treatment systems shall be inspected yearly, or as directed by the regulatory agency and by the manufacturer (for proprietary systems). Maintain as needed using acceptable practices or following manufacturer's guidelines for proprietary systems.  
B. All inlet pipes and Inspection and/or Maintenance Ports in the R-Tank system will need to be inspected for accumulation of sediments at least quarterly through the first year of operation and at least yearly thereafter.  
C. If sediment has accumulated to the level noted in the R-Tank Maintenance Guide or beyond a level acceptable to the Owner's engineer, the R-Tank system should be flushed.  
D. All inspection and maintenance activities should be performed in accordance with the R-Tank Operation, Inspection & Maintenance Manual.

**ACF WEST, INC.**  
GEOTECHNICAL CONSULTANTS  
FOR ADDITIONAL INFORMATION PLEASE CONTACT:  
ACF WEST, 1800 4242 45ST, WWW.ACFWEST.COM

**R-TANK SPECIFICATION**  
EAST TOWN CROSSING  
PUYALLUP, WA  
SITE DESIGNATION: R-TANK 2

EDD  
DATE: 02/21/2024  
PROJECT NUMBER: 23-004WA  
SHEET NO: 8 of 8

NOTICE  
ABSORBER OF THIS DOCUMENT SHALL INDICATE THE PROFESSIONAL SEAL AND SIGNATURE OF THE REGISTERED ENGINEER HAS REVIEWED THIS DOCUMENT AND IT IS APPROVED FOR SUBMITTAL ONLY FOR THE PROJECT DESCRIBED IN THE TITLE BLOCK AND IS NOT TO BE USED FOR OTHER PROJECTS, OR FOR ANY OTHER PROJECT.

City of Puyallup  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title:

## R-TANK 2 NOTES AND DETAILS

Designed by: CW Drawn by: SK/RS Checked by: JI

Sheet No.

# C4.23

30 of 53 Sheets



# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.  
 THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.  
 FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.




Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

Client Contact:  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024

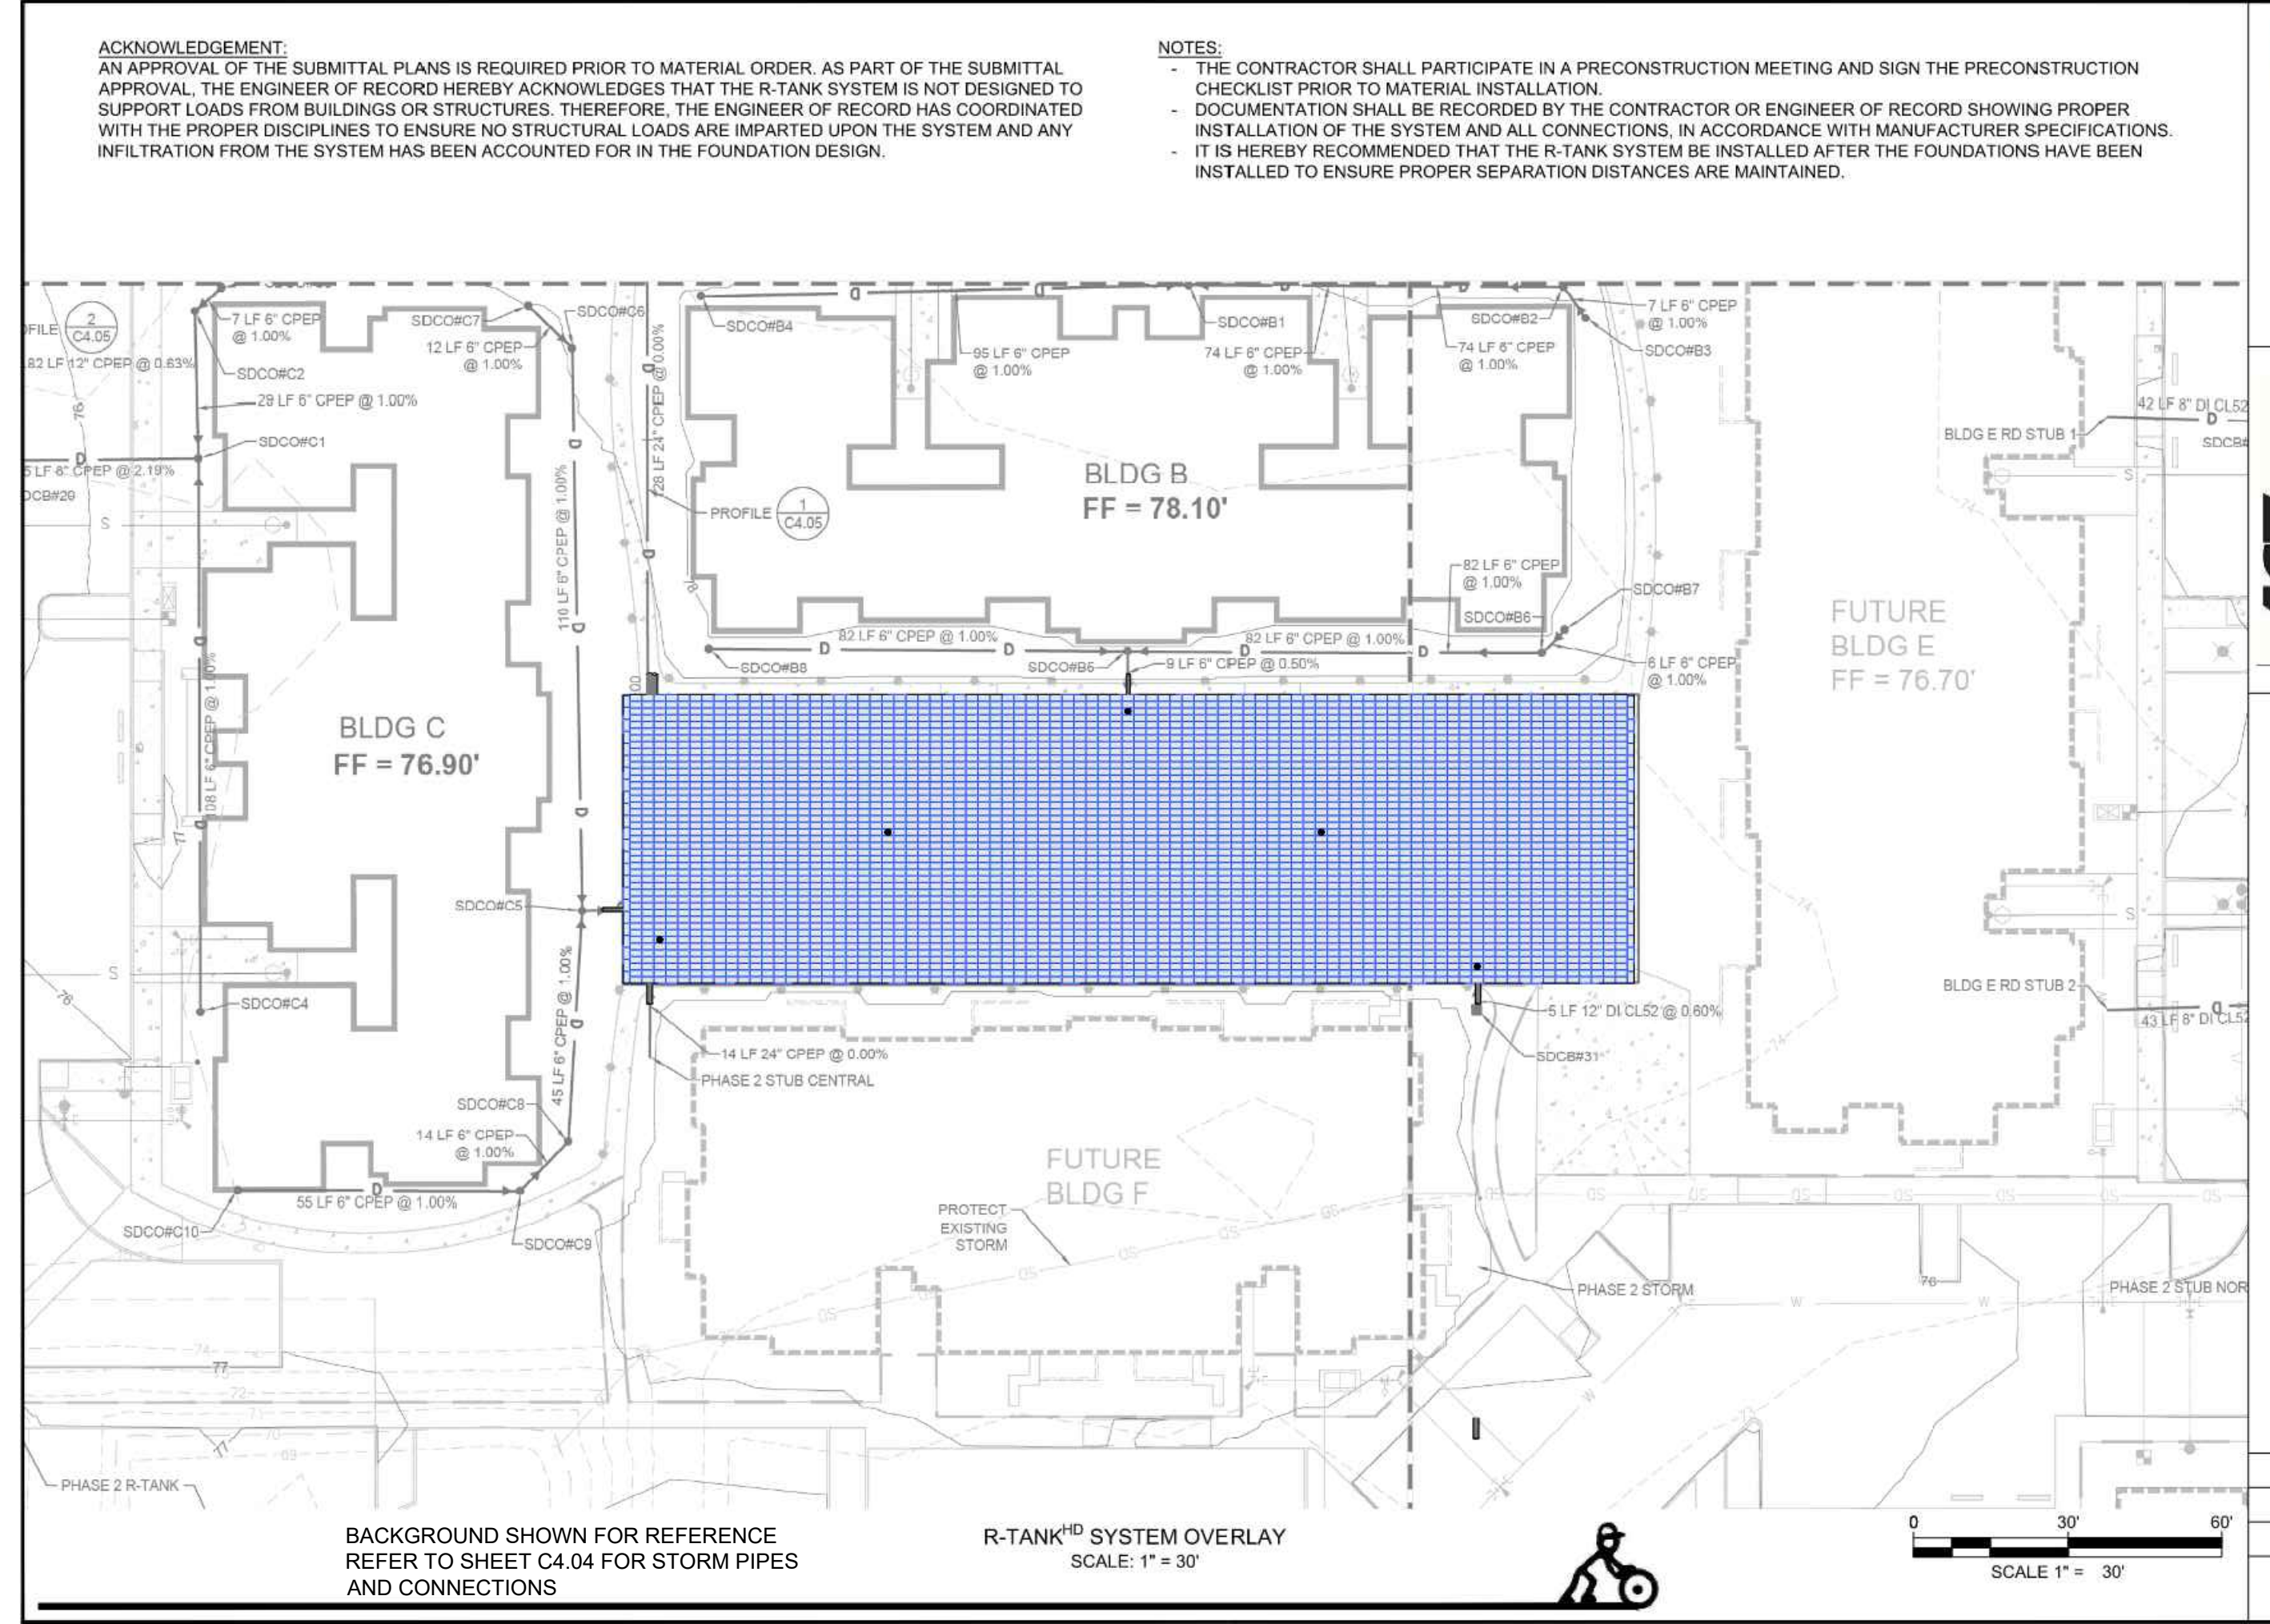


**ACKNOWLEDGEMENT:**  
 AN APPROVAL OF THE SUBMITTAL PLANS IS REQUIRED PRIOR TO MATERIAL ORDER. AS PART OF THE SUBMITTAL APPROVAL, THE ENGINEER OF RECORD HEREBY ACKNOWLEDGES THAT THE R-TANK SYSTEM IS NOT DESIGNED TO SUPPORT LOADS FROM BUILDINGS OR STRUCTURES. THEREFORE, THE ENGINEER OF RECORD HAS COORDINATED WITH THE PROPER DISCIPLINES TO ENSURE NO STRUCTURAL LOADS ARE IMPARTED UPON THE SYSTEM AND ANY INFILTRATION FROM THE SYSTEM HAS BEEN ACCOUNTED FOR IN THE FOUNDATION DESIGN.

**NOTES:**  
 - THE CONTRACTOR SHALL PARTICIPATE IN A PRECONSTRUCTION MEETING AND SIGN THE PRECONSTRUCTION CHECKLIST PRIOR TO MATERIAL INSTALLATION.  
 - DOCUMENTATION SHALL BE RECORDED BY THE CONTRACTOR OR ENGINEER OF RECORD SHOWING PROPER INSTALLATION OF THE SYSTEM AND ALL CONNECTIONS, IN ACCORDANCE WITH MANUFACTURER SPECIFICATIONS.  
 - IT IS HEREBY RECOMMENDED THAT THE R-TANK SYSTEM BE INSTALLED AFTER THE FOUNDATIONS HAVE BEEN INSTALLED TO ENSURE PROPER SEPARATION DISTANCES ARE MAINTAINED.

**R-TANK<sup>®</sup> SYSTEM OVERLAY EAST TOWN CROSSING PUYALLUP, WA SITE DESIGNATION: R-TANK 3**


EDQ  
 02/20/2024  
 23-004WA  
 1 of 6

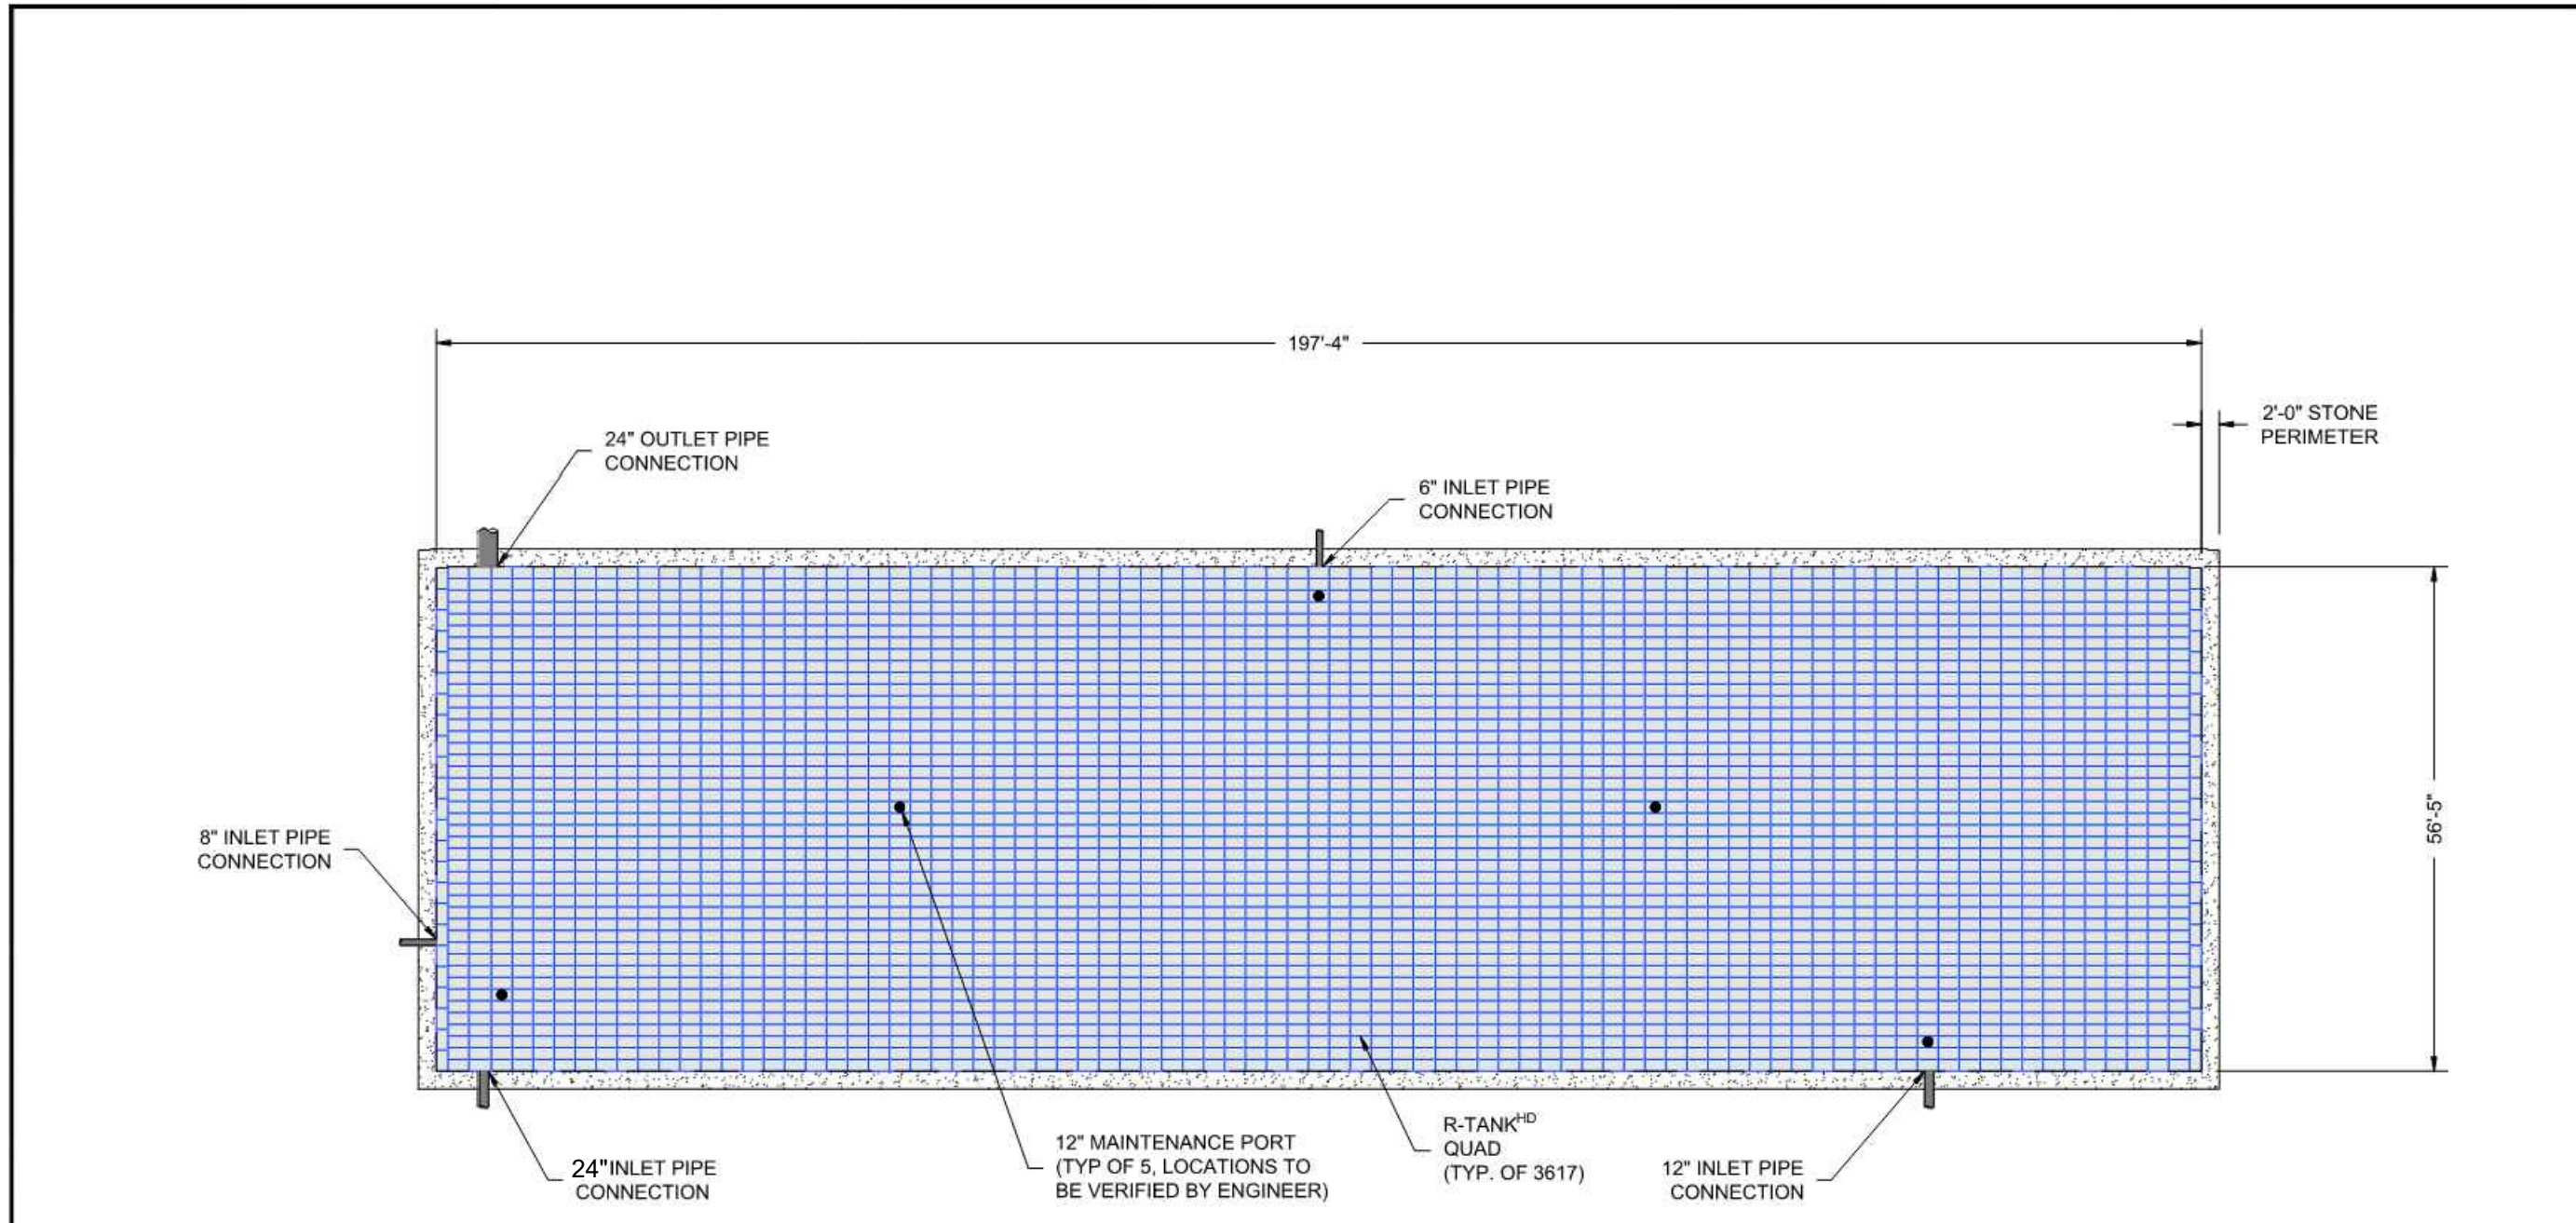

NOTES:  
 1. DEAD STORAGE VOLUME FROM ELEVATION 67.90 TO 68.40 = 2,433 CF  
 2. LIVE STORAGE VOLUME FROM ELEVATION 68.40 TO 74.27 = 62,464 CF  
 3. ONLY 3" OF BASE STONE INCLUDED IN LIVE STORAGE VOLUME.

LAYOUT SCALE	1" = 20'
R-TANK <sup>®</sup> MODULE TYPE	QUAD
TRAFFIC LOAD	HS-20
# OF QUAD R-TANKS	3,727
TOTAL SYSTEM STORAGE	62,464 CF
R-TANK STORAGE VOLUME	60,787 CF
STONE STORAGE VOLUME (40% VOID RATIO)	1,677 CF
NAUE SECUGRID 30/30 GEOGRID ELEV.	75.23
TOP OF COVER STONE ELEV. (12")	75.23
TOP OF R-TANK ELEV.	74.23
TANK INVERT	68.65
INVERT OF STONE BASE (9")	67.90
MIN. STONE PERIMETER WIDTH	2.0 FT

SEE SHEETS 3 - 6 FOR DETAILS AND ADDITIONAL INFORMATION

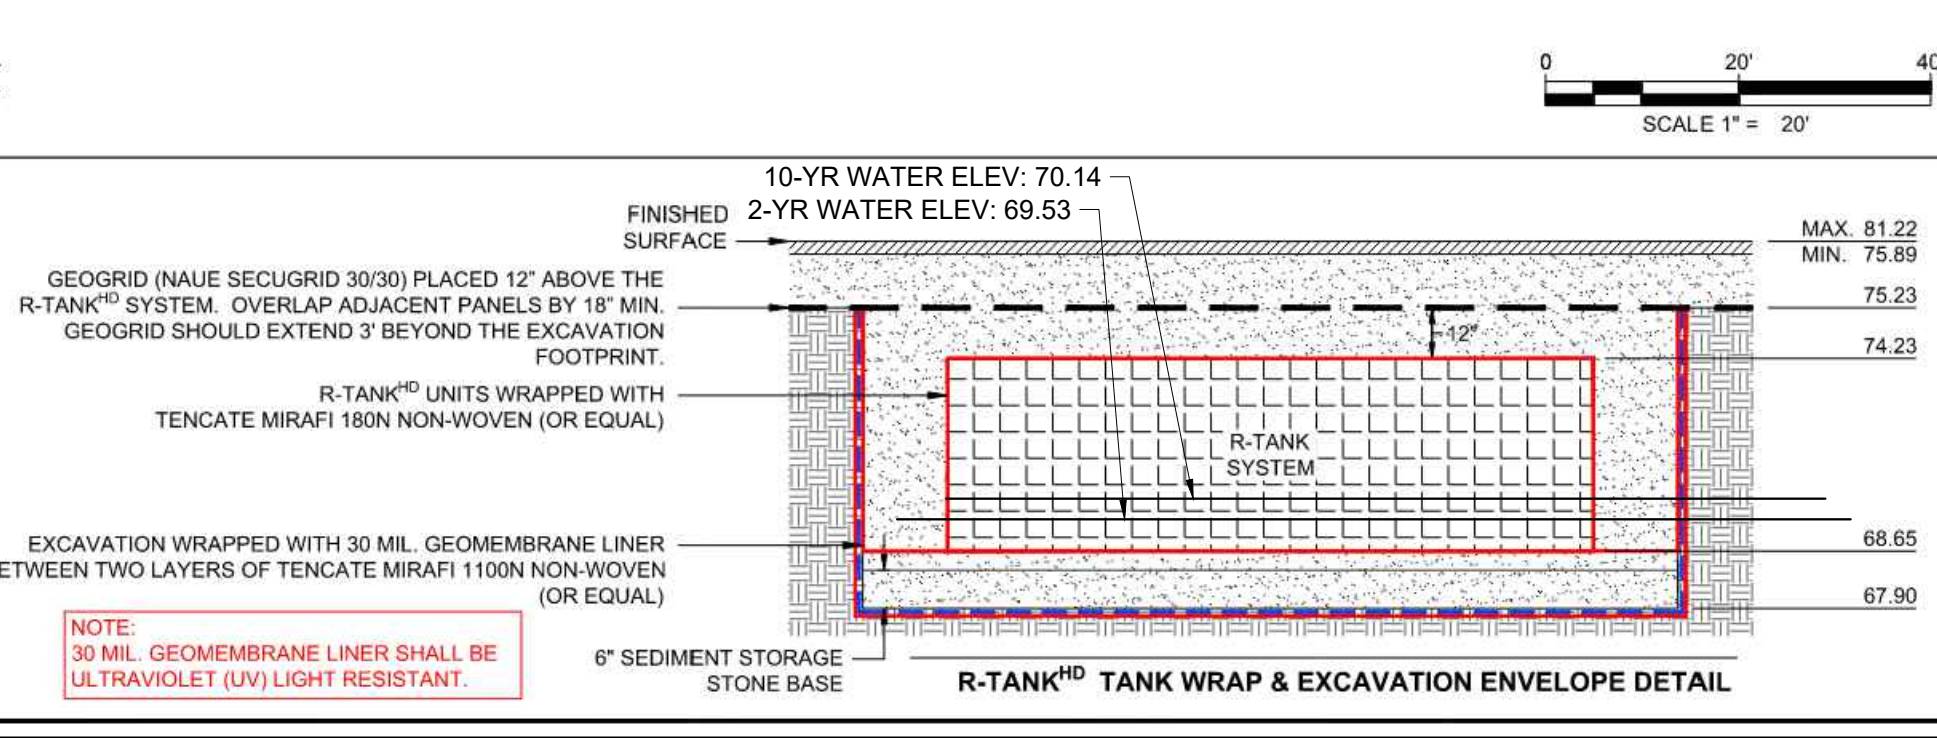

**R-TANK<sup>®</sup> SYSTEM LAYOUT EAST TOWN CROSSING PUYALLUP, WA SITE DESIGNATION: R-TANK 3**

EDQ  
 02/20/2024  
 23-004WA  
 2 of 6

NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A PROFESSIONAL ENGINEER'S RESPONSIBILITY TO THE PUBLIC OR TO THE CITY OF PUYALLUP. THIS DOCUMENT IS FOR THE PROJECT IDENTIFIED IN THE TITLE BLOCK AND IS NOT TO BE USED FOR ANY OTHER PROJECT OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:  
 03/29/24 CITY COMMENTS  
 01/29/24 CITY COMMENTS

### R-TANK 3 NOTES AND DETAILS

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C4.30**  
 31 of 53 Sheets






# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

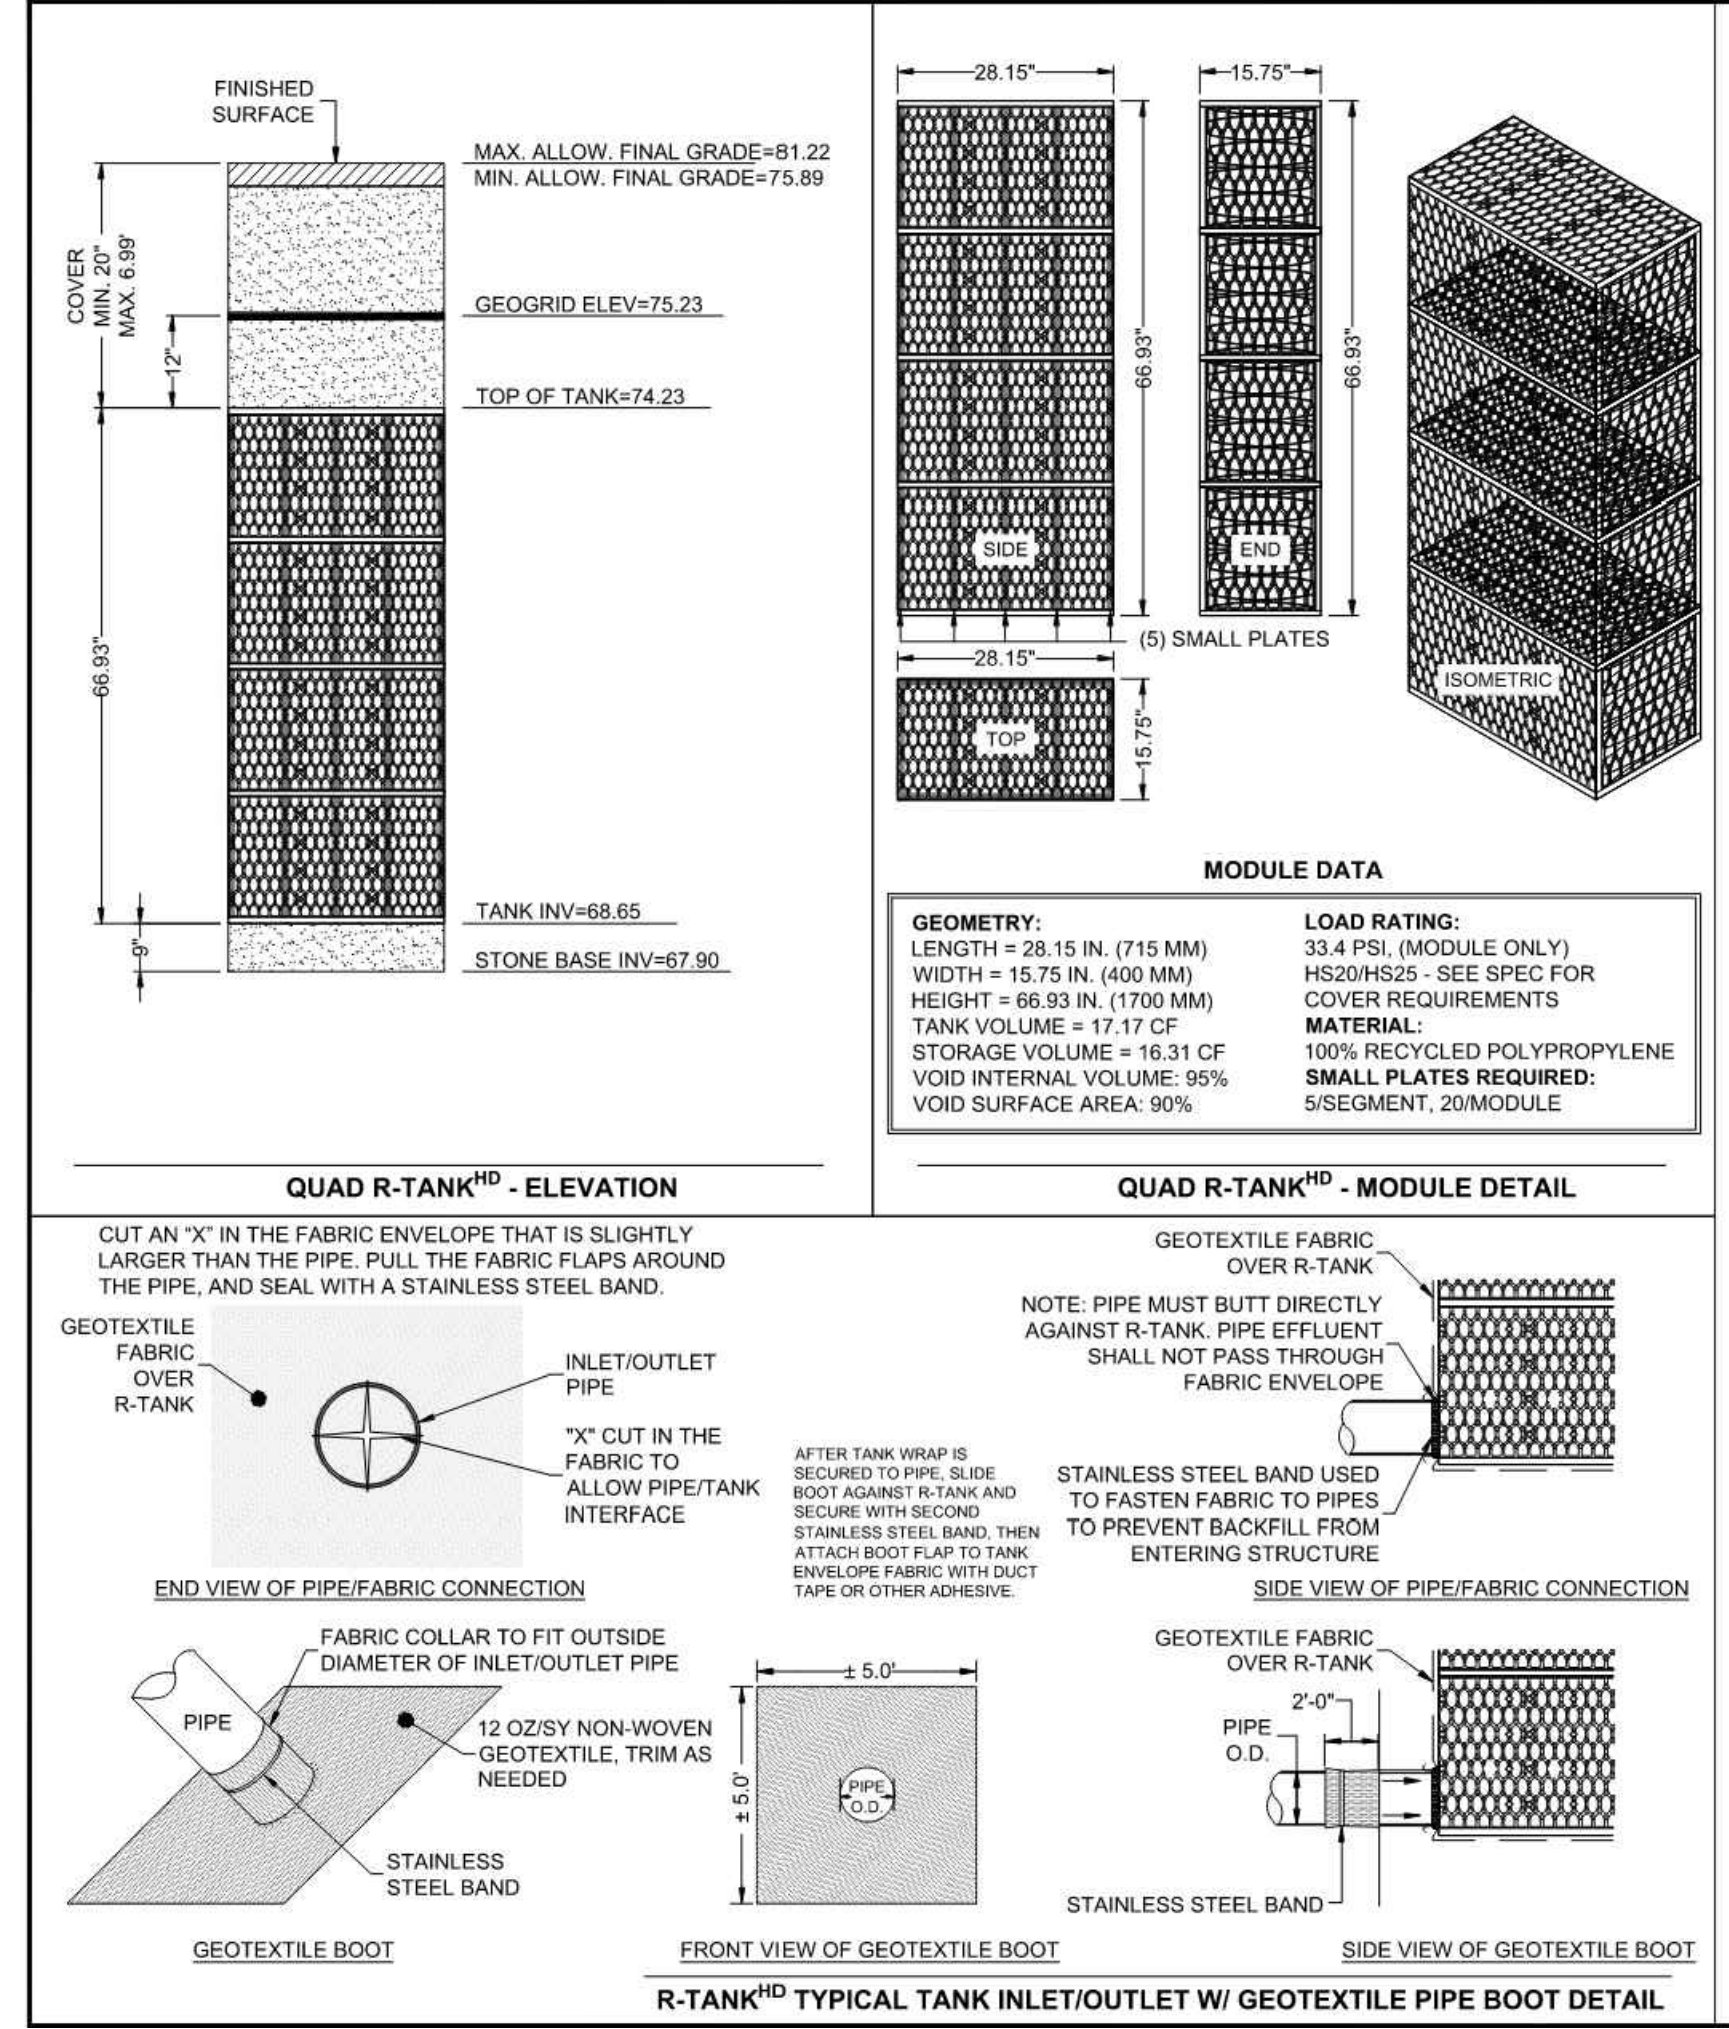


R-TANK <sup>®</sup> QUANTITIES	
R-TANK <sup>®</sup> MODULE TYPE	QUAD
# OF QUAD R-TANKS	3,617
TOTAL SYSTEM STORAGE	67,380 CF
R-TANK STORAGE VOLUME	58,993 CF
STONE STORAGE VOLUME (40% VOID RATIO)	8,387 CF
STONE BED FOOTPRINT	12,167 SF
STONE QUANTITY	1,002 CY
TENCATE MIRAF1 180N NON-WOVEN TANK WRAP	26,872 SF (3,208 SY)
30 MIL. GEOMEMBRANE LINER EXCAVATION WRAP	18,403 SF (2,045 SY)
TENCATE MIRAF1 1100N NON-WOVEN LINER PROTECTION	36,807 SF (4,090 SY)
NAUE SECUGRID 30/30 GEOGRID	14,599 SF (1,622 SY)
12" MAINTENANCE PORTS	5
8" PIPE BOOTS	2
12" PIPE BOOTS	2
24" PIPE BOOTS	1
TRASHGUARD PLUS UNITS (RECOMMENDED)	2




NOTE: STONE QUANTITY INCLUDES 12" OF COVER AND 9" OF BASE.  
 NOTE: GEOTEXTILE / LINER QUANTITIES INCLUDE A 15% WASTE FACTOR.

NOTE: 30 MIL. GEOMEMBRANE LINER SHALL BE ULTRAVIOLET (UV) LIGHT RESISTANT.

NOTES:  
 1. DEAD STORAGE VOLUME FROM ELEVATION 67.90 TO 88.40 = 2,433 CF  
 2. LIVE STORAGE VOLUME FROM ELEVATION 68.40 TO 75.23 = 67,380 CF  
 3. ONLY 3" OF BASE STONE INCLUDED IN LIVE STORAGE VOLUME.

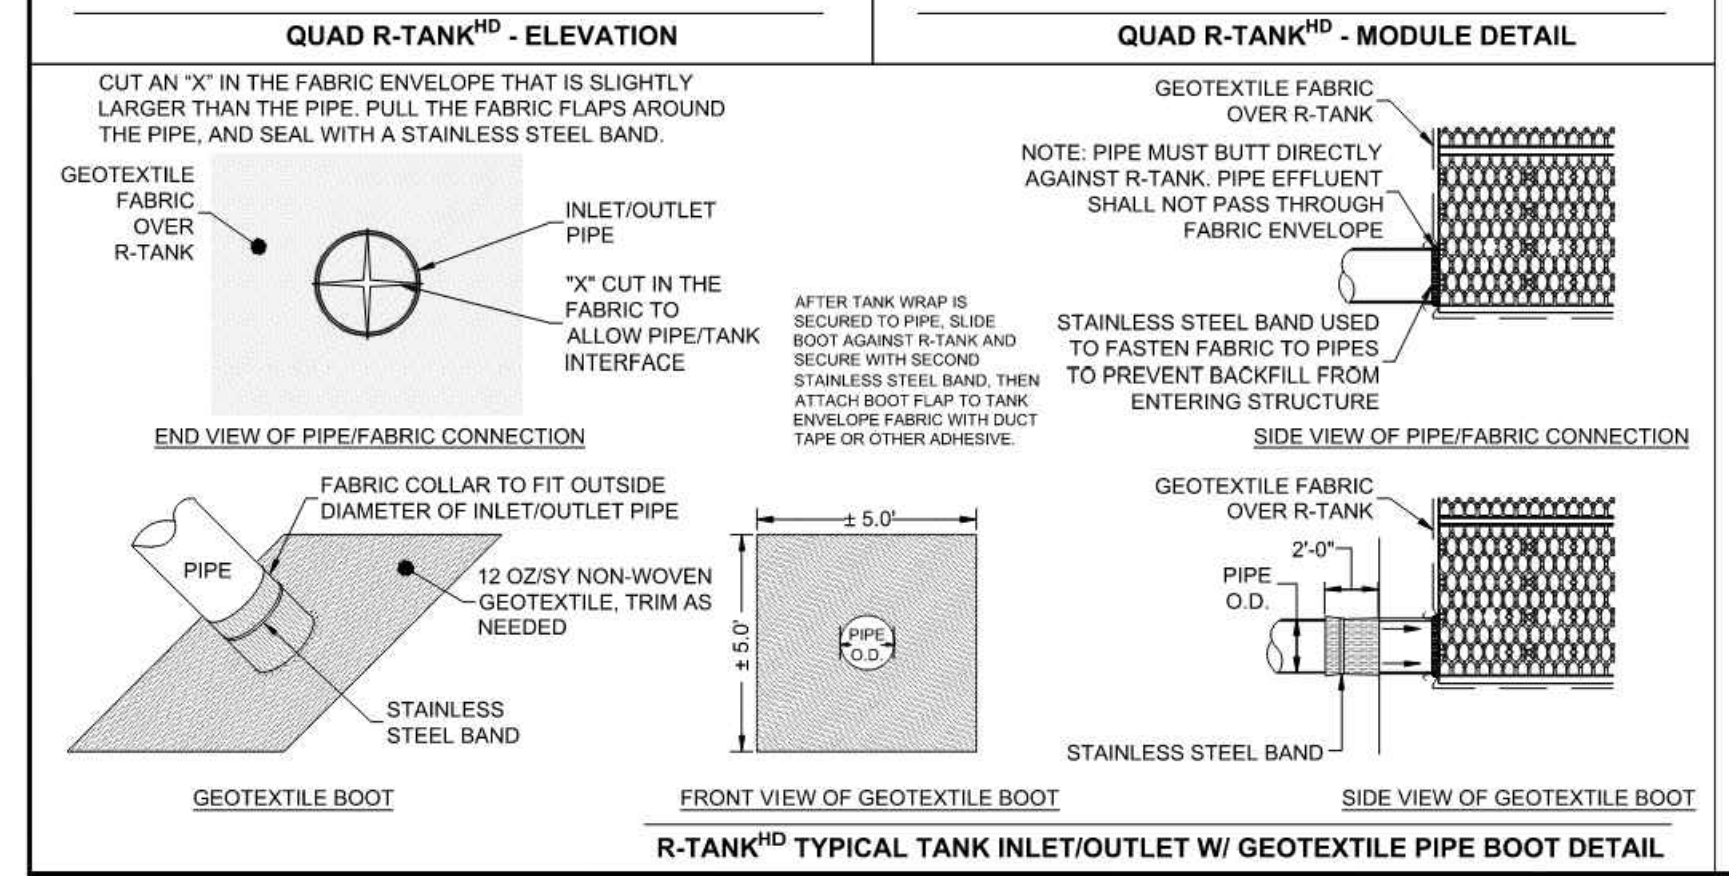

**R-TANK<sup>®</sup> SYSTEM DETAILS**  
 EAST TOWN CROSSING  
 PUYALLUP, WA  
 SITE DESIGNATION: R-TANK 3  
 3 of 6

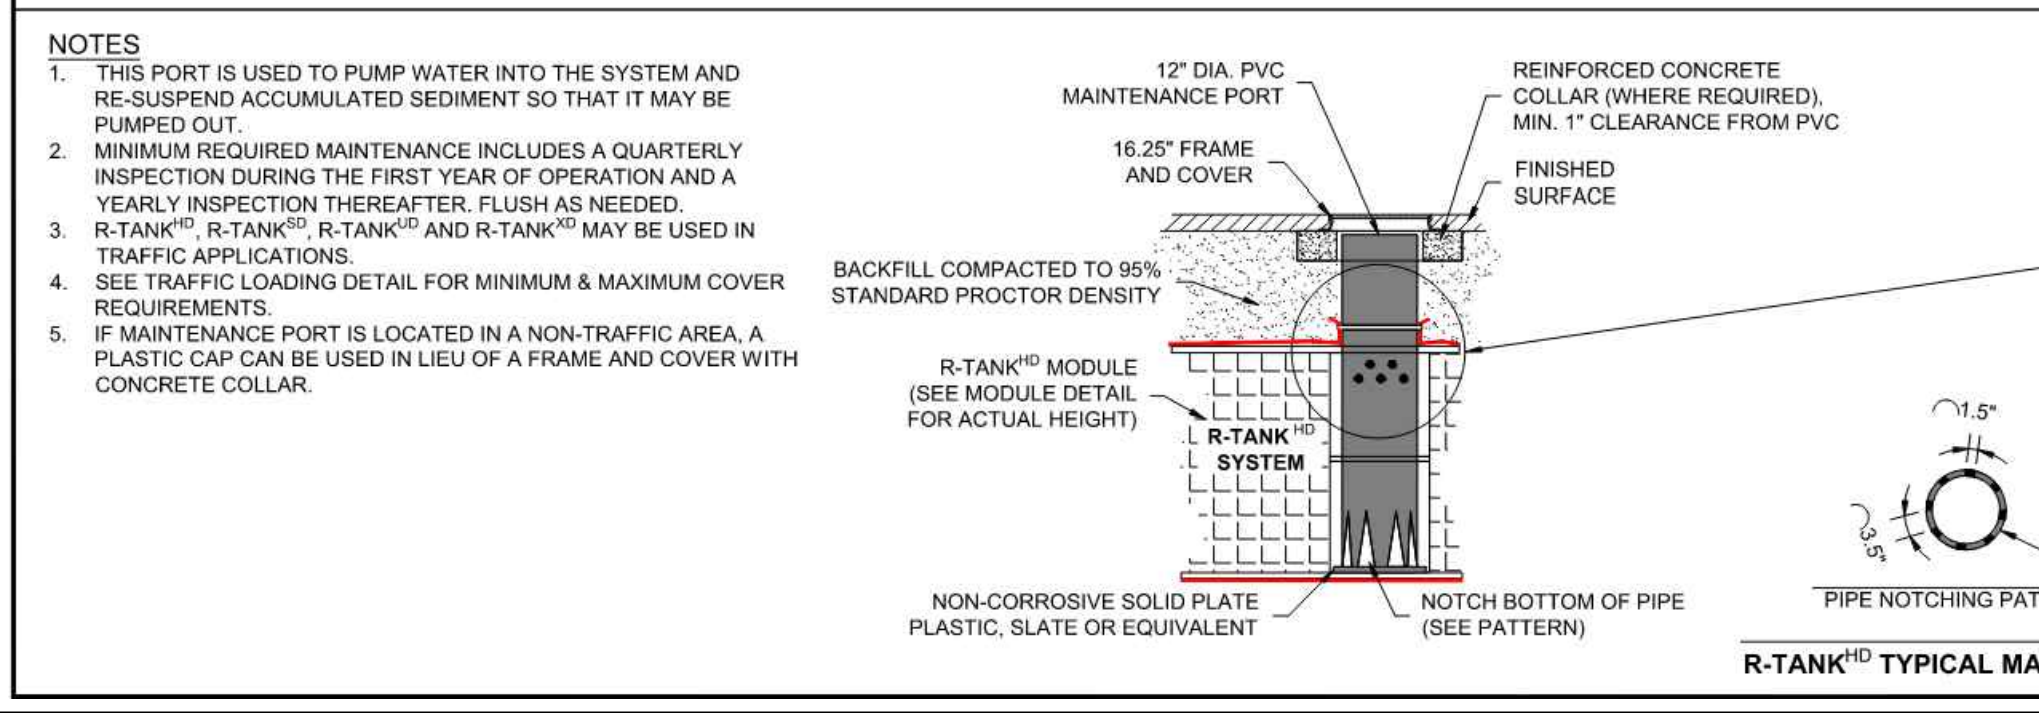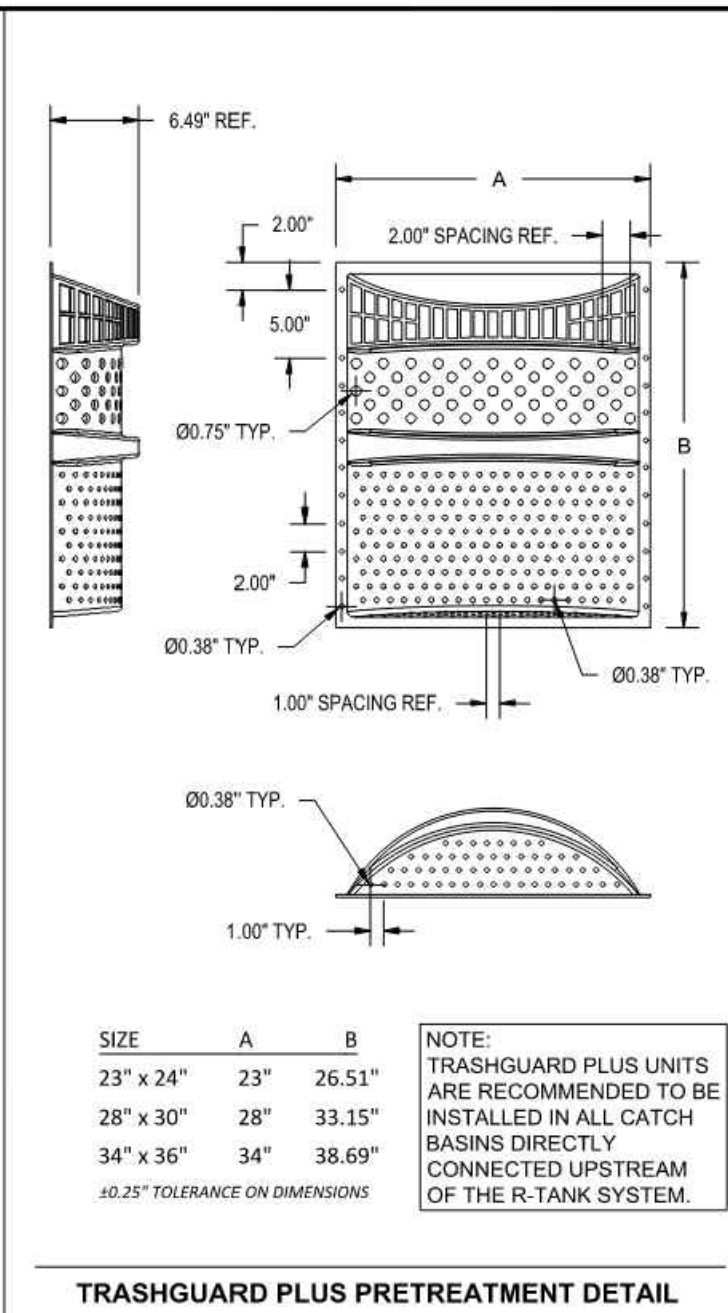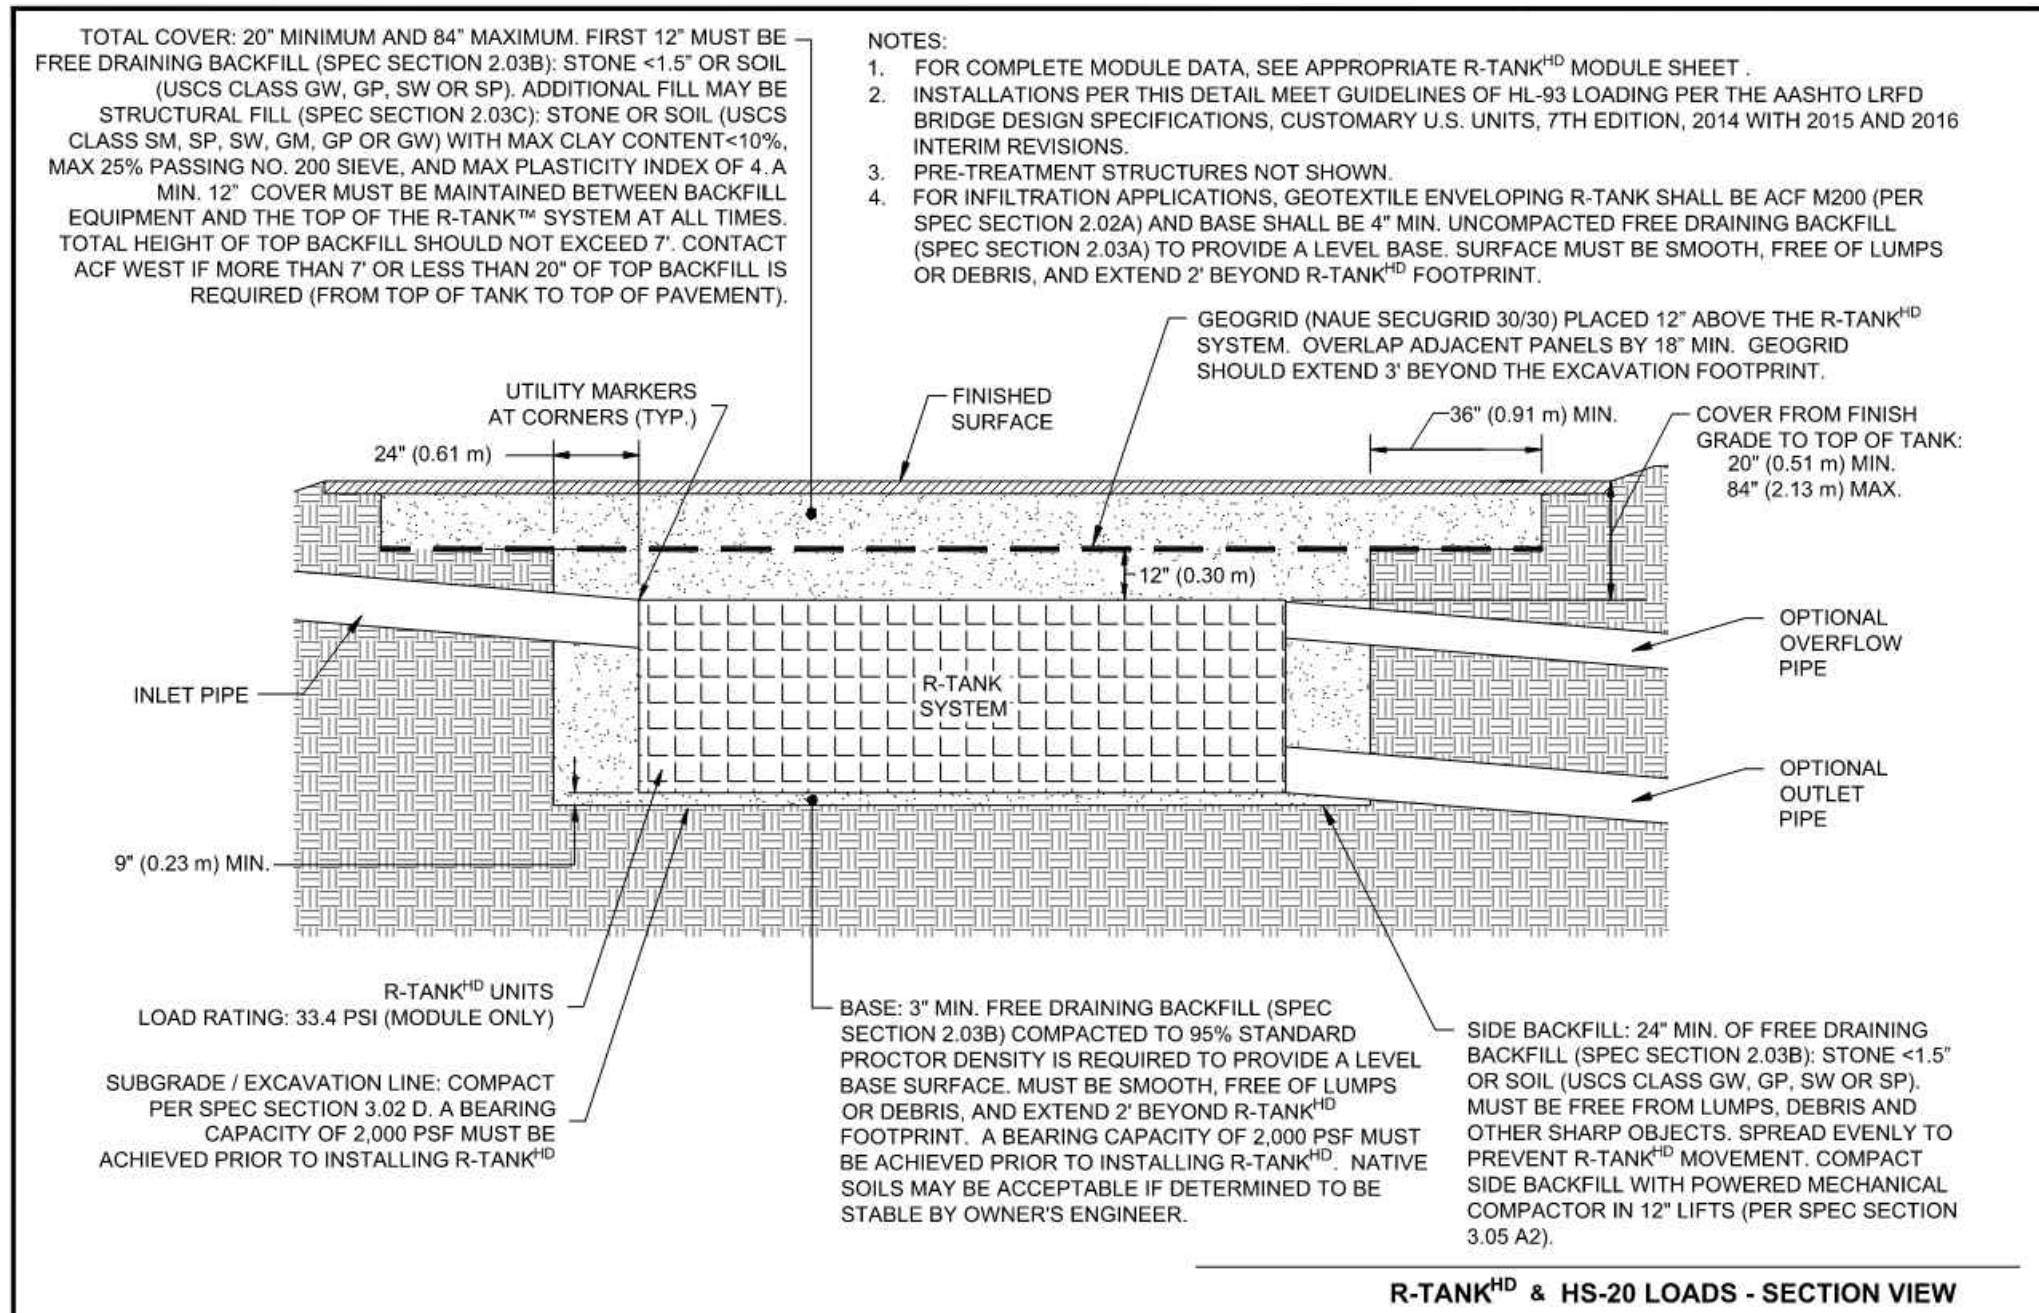

**R-TANK<sup>®</sup> SYSTEM DETAILS**  
 EAST TOWN CROSSING  
 PUYALLUP, WA  
 SITE DESIGNATION: R-TANK 3  
 4 of 6

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024

City of Puyallup Development & Permitting Services  
**ISSUED PERMIT**

Building Planning  
 Engineering Public Works  
 Fire Traffic

Revisions:  
 03/29/24 CITY COMMENTS  
 01/29/24 CITY COMMENTS

Sheet Title:  
**R-TANK 3 NOTES AND DETAILS**

Designed by: CW Drawn by: SK/RS Checked by: JI

Sheet No.  
**C4.31**  
 32 of 53 Sheets





# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

ACOMA • SEATTLE • SPOKANE • TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE AN ENDORSEMENT OR A GUARANTEE OF THE QUALITY OF THE DESIGN OR THE ACCURACY OF THE INFORMATION PROVIDED HEREON. THE USER SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND FOR THE PROTECTION OF THE PUBLIC. NO PART OF THIS DOCUMENT IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT PERMISSION IN WRITING FROM THE AUTHOR.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS


01/29/24 CITY COMMENTS

Revisions:

Sheet Title:

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C4.32**  
 33 of 53 Sheets

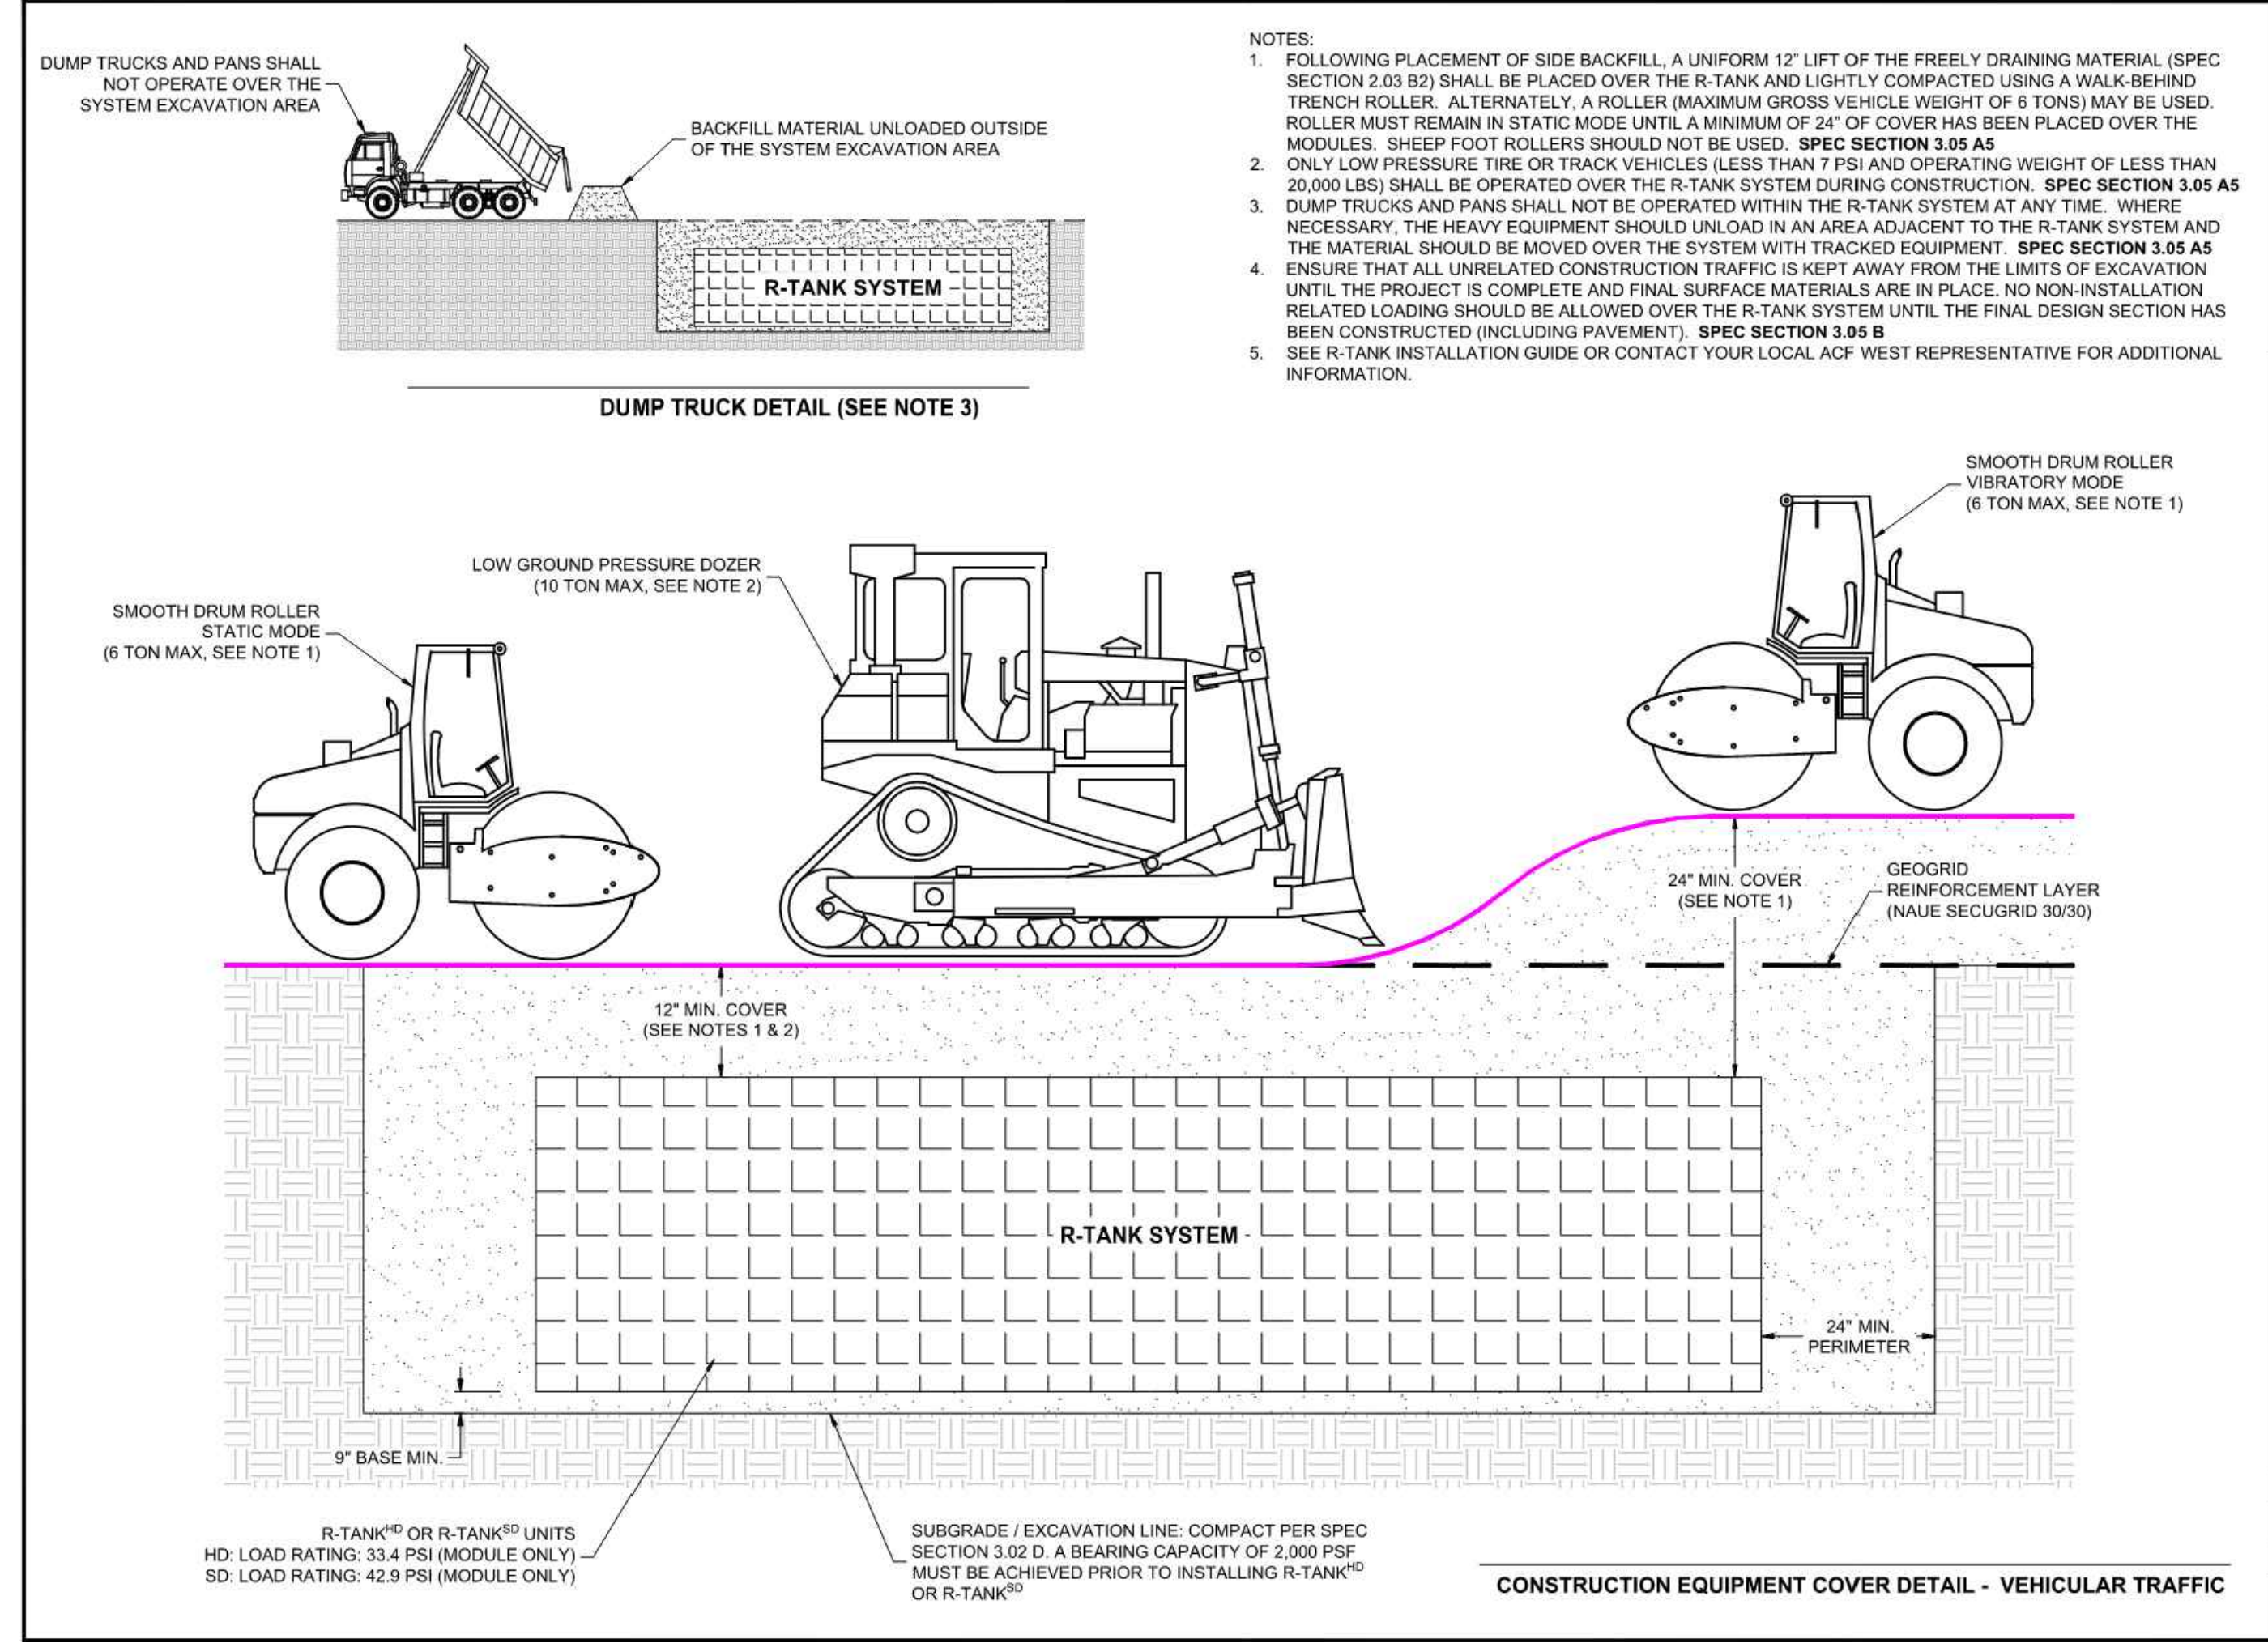

NOTES:  
 1. FOLLOWING PLACEMENT OF SIDE BACKFILL, A UNIFORM 12" LIFT OF THE FREELY DRAINING MATERIAL (SPEC SECTION 2.03 B2) SHALL BE PLACED OVER THE R-TANK AND LIGHTLY COMPACTED USING A WALK-BEHIND TRENCH ROLLER. ALTERNATELY, A ROLLER (MAXIMUM GROSS VEHICLE WEIGHT OF 6 TONS) MAY BE USED. ROLLER MUST REMAIN IN STATIC MODE UNTIL A MINIMUM OF 24" OF COVER HAS BEEN PLACED OVER THE MODULES. SHEEP FOOT ROLLERS SHOULD NOT BE USED. SPEC SECTION 3.05 A5  
 2. ONLY LOW PRESSURE TIRE OR TRACK VEHICLES (LESS THAN 7 PSI AND OPERATING WEIGHT OF LESS THAN 20,000 LBS) SHALL BE OPERATED OVER THE R-TANK SYSTEM DURING CONSTRUCTION. SPEC SECTION 3.05 A5  
 3. DUMP TRUCKS AND PANS SHALL NOT BE OPERATED WITHIN THE R-TANK SYSTEM AT ANY TIME. WHERE NECESSARY, THE HEAVY EQUIPMENT SHOULD UNLOAD IN AN AREA ADJACENT TO THE R-TANK SYSTEM AND THE MATERIAL SHOULD BE MOVED OVER THE SYSTEM WITH TRACKED EQUIPMENT. SPEC SECTION 3.05 A5  
 4. ENSURE THAT ALL UNRELATED CONSTRUCTION TRAFFIC IS KEPT AWAY FROM THE LIMITS OF EXCAVATION UNTIL THE PROJECT IS COMPLETE AND FINAL SURFACE MATERIALS ARE IN PLACE. NO NON-INSTALLATION RELATED LOADING SHOULD BE ALLOWED OVER THE R-TANK SYSTEM UNTIL THE FINAL DESIGN SECTION HAS BEEN CONSTRUCTED (INCLUDING PAVEMENT). SPEC SECTION 3.05 B  
 5. SEE R-TANK INSTALLATION GUIDE OR CONTACT YOUR LOCAL ACF WEST REPRESENTATIVE FOR ADDITIONAL INFORMATION.

### R-TANK SPECIFICATION

PART 1 - GENERAL

1.01 RELATED DOCUMENTS  
 A. Drawings, technical specification and general provisions of the Contract as modified herein apply to this section.

1.02 DESCRIPTION OF WORK INCLUDED  
 A. Provide excavation and base preparation per geotechnical engineer's recommendations and/or as shown on the design drawings, to provide adequate support for project design loads and safety from excavation related collapse. Excavations shall be in accordance with the owner's and OSHA requirements.  
 B. Provide and install R-Tank, DR, R-TankSD, R-TankSDU, or R-TankUD system (hereafter called R-Tank) and all related products including fill materials, geotextiles, geogrids, inlets and outlet pipes with connections per the manufacturer's installation guidelines provided in this section.  
 C. Provide and construct the cover of the R-Tank system including: stone backfill, structural fill cover, and pavement section as specified.  
 D. Protect R-Tank system from construction traffic after installation until completion of all construction activity in the installation area.

1.03 QUALITY CONTROL  
 A. All materials shall be manufactured in ISO certified facilities.  
 B. Installer/Contractor shall demonstrate the following experience:  
 1. A minimum of three R-Tank or equivalent projects completed within 2 years; and  
 2. A minimum of 25,000 cubic feet of stone volume completed within 2 years.  
 C. Contractor experience requirement may be waived if the manufacturer's representative provides on-site training and review during construction.  
 D. Installation Personnel: Performed only by skilled workers with satisfactory record of performance on bulk earthworks, pipe, chamber, or post-tensioned construction projects of comparable size and quality.  
 E. Contractor must have manufacturer's representative available for site review if requested by owner.

1.04 SUBMITTALS  
 A. Submit proposed R-Tank layout drawings. Drawings shall include typical section details as well as the required base elevation of stone and tanks, minimum cover requirements and tank configuration.  
 B. Submit manufacturer's product data, including compressive strength and unit weight.  
 C. Submit manufacturer's installation instructions.  
 D. Submit R-Tank sample for review. Retrieved and accepted samples will be returned to the Contractor.  
 E. Submit material certificates for geotextile, geogrid, base course and backfill materials.  
 F. Submit required experience and personnel requirements as specified in Section 1.03.  
 G. Any proposed equal alternative product substitution to this specification must be submitted for review and approved prior to bid opening. Review package should include third party reviewed performance data that meets or exceeds criteria in Table 2.01 B.

1.05 DELIVERY, STORAGE, AND HANDLING  
 Protect R-Tank and other materials from damage during delivery, and store UV sensitive materials under tarp to protect from sunlight when time from delivery to installation exceeds two weeks. Storage of materials should be on smooth surfaces, free from dirt, mud and debris.  
 B. Handling is to be performed with equipment appropriate to the materials and site conditions, and may include hand, handcart, forklifts, extension ladders, etc.  
 C. Cold weather:  
 1. Cans must be taken when handling plastics when air temperature is 40 degrees below or below as plastic becomes brittle.  
 2. Do not use frozen materials or materials moist or coated with ice or frost.  
 3. Do not build up frozen ground or wind, vibration or muddy soilgrads.

1.06 PREINSTALLATION CONFERENCE  
 Prior to the start of the installation, a preinstallation conference shall occur with the representatives from the design team, the general contractor, the excavation contractor, the R-Tank installation contractor, and the manufacturer's representative.

1.07 PROJECT CONDITIONS  
 A. Coordinate installation for the R-Tank system with other on-site activities to eliminate all non-installation related construction traffic over the completed R-Tank system. No loads heavier than the design loads shall be allowed over the system, and in no case shall loads heavier than a standard ASHRAE H320 (or H525, depending on design criteria) load be allowed on the system at any time.  
 B. Protect adjacent work from damage during R-Tank system installation.  
 C. All pre-treatment systems to remove debris and heavy sediments must be in place and functional prior to operation of the R-Tank system. Additional pretreatment measures may be needed if unit is operational during construction due to increased sediment loads.  
 D. Contractor is responsible for any damage to the system during construction.

PART 2 - PRODUCTS

2.01 R-TANK UNITS  
 A. R-Tank - injection molded plastic tank assembly to form a 95% void modular structure of pre-designed height (custom for each project).  
 B. R-Tank units shall meet the following Physical & Chemical Characteristics:

PROPERTY	UNITS	MINIMUM VALUE	MAXIMUM VALUE	TEST METHOD	ACCEPTANCE
Material		95%	95%	ASTM D1681	95%
Compressive Strength	psi	1000	1000	ASTM D1681	1000
Flexural Strength	psi	1000	1000	ASTM D1681	1000
Impact Strength	ft-lb	1000	1000	ASTM D1681	1000
Water Absorption	%	0.5	0.5	ASTM D1681	0.5
Chemical Resistance		100%	100%	ASTM D1681	100%
UV Resistance		100%	100%	ASTM D1681	100%
Temperature Resistance		100%	100%	ASTM D1681	100%
Flammability		100%	100%	ASTM D1681	100%
Fire Retardancy		100%	100%	ASTM D1681	100%
Static Dissipative		100%	100%	ASTM D1681	100%
Electrical Insulation		100%	100%	ASTM D1681	100%
Acoustic Insulation		100%	100%	ASTM D1681	100%
Sealing		100%	100%	ASTM D1681	100%
Supplier		ACF WEST 15540 Woodville-Rodmond Rd., Woodville, Washington 98072, (425) 415-6115, www.acfwest.com			

2.02 GEOSYNTHETICS  
 A. Geotextile: A geotextile envelope is required to prevent backfill material from entering the R-Tank modules.  
 B. Standard Applications: The geotextile envelope shall be an 8' or square and nonwoven geotextile (TenCate Mitril 1800 or equivalent) and be used.  
 C. Geogrid: For installations subject to traffic loads and/or when required by project plans, install geogrid (Naue Secugrid 3030 or equivalent) to reinforce backfill over the R-Tank system. Geogrid is not always required for R-TankSD installations, but is often required for non-traffic load applications.  
 D. MANUFACTURED 3D MESH IMPERMEABLE LINER TO PREVENT GROUNDWATER INTRUSION.

2.03 BACKFILL & COVER MATERIALS  
 A. Backfill Materials: Stone (angular and smaller than 1.5" in diameter) or soil (GW, GP, SW, or SP as classified by the Unified Soil Classification System) shall be used below the R-Tank system (2" minimum). Material must be free from lumps, debris, and any sharp objects that could cut the geotextile. Material shall be within 3 percent of the optimum moisture content as determined by ASTM D698 at the time of installation. For infiltration applications bedding material shall be free draining.  
 B. Sides and Top Backfill: Material must be free from lumps, debris and any sharp objects that could cut the geotextile. Material shall be within 3 percent of the optimum moisture content as determined by ASTM D698 at the time of installation.  
 C. Traffic Applications: Free draining material shall be used adjacent to (24" minimum) and above (for full 12" R-Tank system) and above (for HD, SD, GP, SW, or SP as classified by the Unified Soil Classification System).  
 D. For HD modules with less than 14" of top cover, backfill materials shall be free draining stone (angular and smaller than 1.5" in diameter) or soil (GW, GP, SW, or SP as classified by the Unified Soil Classification System).  
 E. For LD modules with less than 14" of top cover, backfill materials shall be free draining stone (angular and smaller than 1.5" in diameter) or soil (GW, GP, SW, or SP as classified by the Unified Soil Classification System).  
 F. Non-Traffic / Green Space Applications: For all R-Tank modules installed in green spaces and not subjected to vehicular loads, backfill materials may either follow the guidelines for Traffic Applications above, or the top backfill layer (1.5" minimum) may consist of AASHTO #57 stone blended with 30-40% (by volume) topsoil and in establishing vegetation.  
 G. Additional Cover Materials: Structural Fill shall consist of granular materials meeting the gradational requirements of SM, SP, SW, GM, GP or GW as classified by the Unified Soil Classification System. Structural Fill shall have a maximum of 25 percent passing the No. 200 sieve, shall have a maximum dry content of 10 percent and a maximum Plasticity Index of 4. Material shall be within 3 percent of the optimum moisture content as determined by ASTM D698 at the time of installation.

2.04 OTHER MATERIALS  
 A. Utility Marker: Install metallic tape at corners of R-Tank system to mark the area for future utility detection.

3.01 ASSEMBLY OF R-TANK UNITS  
 A. Assembly of modules shall be performed in accordance with the R-Tank Installation Manual, Section 2.

3.02 LAYOUT AND EXCAVATION  
 A. Excavate and install stone backfill, and prepare the subgrade area to the required plan grades and dimensions, ensuring that the excavation is at least 2 feet greater than R-Tank dimensions in each direction allowing for installation of geotextile liner fabric, R-Tank modules, and free draining backfill materials.  
 B. All excavations must be prepared with OSHA approved excavated sides and sufficient working space.  
 C. Protect partially completed installation against damage from other construction traffic by establishing a perimeter with high visibility construction tape, fencing, barricades, or other means until construction is complete.  
 D. Base of the excavation shall be uniform, level, and free of lumps or debris and soft or yielding subgrade areas. A minimum 2,000 pounds per square foot bearing capacity is required.  
 E. Infiltration Applications: Subgrade shall be prepared in accordance with the contract documents. Compaction of subgrade should not be performed in infiltration applications.  
 F. Unsuitable Soils or Conditions: All questions about the base of the excavation shall be directed to the owner's engineer, who will approve the subgrade conditions prior to placement of stone. The owner's engineer shall determine the required bearing capacity of the R-Tank subgrade, however in no case shall the bearing capacity be less than 2,000 pounds per square foot be provided.  
 1. If unsuitable soils are encountered at the subgrade, or if the subgrade is pumping or appears excessively soft, repair the area in accordance with contract documents and/or as directed by the owner's engineer.  
 2. If indications of the water table are observed during excavation, the engineer shall be contacted to provide recommendations.  
 3. Do not start installation of the R-Tank system until satisfactory subgrade conditions are corrected and the subgrade conditions are accepted by the owner's engineer.

3.03 PREPARATION OF BASE  
 A. Place a thin layer (2" unless otherwise specified) of bedding material (Section 2.03 A), over the subgrade to establish a level working platform for the R-Tank modules. Level to within 1/4" (+/- 1/4") or as shown on the plans. Native subgrade soils or other materials may be used if determined to meet the requirements of 2.03 A and are accepted by the owner's engineer.  
 B. Standard Applications: Static roll or otherwise compact bedding materials until they are firm and unyielding.  
 C. Infiltration Applications: Bedding materials shall be prepared in accordance with the contract documents.  
 D. Outline the footprint of the R-Tank system on the excavation floor using spray paint or chalk line to ensure a 2" perimeter is available around the R-Tank system for proper installation and compaction of backfill.

3.04 INSTALLATION OF THE R-TANKS  
 A. Where a geotextile wrap is specified on the stone base, cut strips to length and install in excavation, removing wrinkles so material lays flat. Overlay geotextile a minimum 12" or as recommended by manufacturer. Use tape, special adhesives, sandbags or other ballast to secure overlaps. As geotextiles can be damaged by extreme heat, smoking is not permissible on-site. Flame, cut and any other operations of the geotextile and optional liner. These operations should be installed flush (but not to the R-Tank) and the geotextile fabric shall be cut to enable hydraulic continuity between the connections and the R-Tank units. These connections shall be secured using pipe boots with stainless steel clip clamps. Support pipe in trenches during bedding operations to prevent pipe from settling and damaging the geotextile, impervious liner if specified or pipe. Connecting pipes at 90 degree angles facilitates construction, unless otherwise specified. Ensure end of pipe is installed snug against R-Tank system.  
 B. Install infiltration applications and maintenance ports on the R-Tank system. A minimum one maintenance port shall be installed within 12" of each inlet & outlet connection, and with a maximum spacing of one maintenance port for every 2,500 square feet. Install all ports as noted in the R-Tank Installation Guide.  
 C. If required, install venting pipes and vents as specified on drawings to provide ventilation for proper hydraulic performance. The number of pipes and vents will depend on the size of the system. Vents are often installed using a 90 degree elbow with PVC pipe into a landscaped area with UV band or venting ballast to inhibit the ingress of debris. A ground level concrete or steel cover can be used.  
 D. For UD installations, there is no perpendicular and no required.  
 E. Prep R-Tank top and sides in specified geotextile. Cut strips of geotextile so that it will cover the sides and top, encapsulating the entire system to prevent backfill entry into the system. Overlay geotextile 12" or as recommended by manufacturer. Take great care to avoid damage to geotextile (and, if specified, impervious liner) during placement.  
 F. Identify locations of inlet, outlet and any other operations of the geotextile and optional liner. These connections should be installed flush (but not to the R-Tank) and the geotextile fabric shall be cut to enable hydraulic continuity between the connections and the R-Tank units. These connections shall be secured using pipe boots with stainless steel clip clamps. Support pipe in trenches during bedding operations to prevent pipe from settling and damaging the geotextile, impervious liner if specified or pipe. Connecting pipes at 90 degree angles facilitates construction, unless otherwise specified. Ensure end of pipe is installed snug against R-Tank system.  
 G. Install infiltration applications and maintenance ports on the R-Tank system. A minimum one maintenance port shall be installed within 12" of each inlet & outlet connection, and with a maximum spacing of one maintenance port for every 2,500 square feet. Install all ports as noted in the R-Tank Installation Guide.  
 H. If required, install venting pipes and vents as specified on drawings to provide ventilation for proper hydraulic performance. The number of pipes and vents will depend on the size of the system. Vents are often installed using a 90 degree elbow with PVC pipe into a landscaped area with UV band or venting ballast to inhibit the ingress of debris. A ground level concrete or steel cover can be used.

3.05 BACKFILL OF THE R-TANK UNITS  
 A. Place freely draining backfill materials (Section 2.03 B) around the perimeter in lifts with a maximum thickness of 12". Each lift shall be placed around the entire perimeter such that each lift is no more than 24" higher than the side backfill along any other location on the perimeter of the R-Tank system. No lift shall be placed over top of tanks until the side backfill has been completed.  
 B. Each lift shall be compacted at the specified moisture content to a minimum of 95% of the Standard Proctor Density until no further densification is observed (for self-compacting stone materials) the side lifts must be compacted with walk behind compaction equipment. Even when "self-compacting" backfill materials are selected, a walk behind vibratory compactor must be used.  
 C. Take care to ensure that the compaction process does not allow the machinery to come into contact with the modules due to the potential for damage to the geotextile and R-Tank units.  
 D. No compaction equipment is permissible to operate directly on the R-Tank modules.  
 E. Top Backfill: Only low pressure track vehicles shall be operated over the R-Tank system during construction. Dump Trucks and Pans shall not be operated within the R-Tank system footprint at any time. Heavy equipment should be used in an area adjacent to the R-Tank system and the material should be moved over the system using tracked equipment with an operating weight of less than 10 tons.  
 F. Typical Applications: Install a 12" or as shown on plans (if) of freely draining material (Section 2.03 B) over the R-Tank Units, maintaining 12" between equipment tracks and R-Tank System. Lightly compact using a walk-behind trench roller. Alternatively, a roller (maximum gross vehicle weight of 6 tons) may be used. Roller must remain in static mode a minimum of 24" of cover has been placed over the modules. Sheep foot rollers should not be used.  
 G. Shadow Applications (1" fill over) install top backfill in accordance with plans.  
 H. Infiltration Applications: Backfill material shall be placed in lifts with a maximum thickness of 12". Each lift shall be placed around the entire perimeter such that each lift is no more than 24" higher than the side backfill along any other location on the perimeter of the R-Tank system. No lift shall be placed over top of tanks until the side backfill has been completed.  
 I. Backfill shall be compacted at the specified moisture content to a minimum of 95% of the Standard Proctor Density until no further densification is observed (for self-compacting stone materials) the side lifts must be compacted with walk behind compaction equipment. Even when "self-compacting" backfill materials are selected, a walk behind vibratory compactor must be used.  
 J. Take care to ensure that the compaction process does not allow the machinery to come into contact with the modules due to the potential for damage to the geotextile and R-Tank units.  
 K. No compaction equipment is permissible to operate directly on the R-Tank modules.  
 L. Top Backfill: Only low pressure track vehicles shall be operated over the R-Tank system during construction. Dump Trucks and Pans shall not be operated within the R-Tank system footprint at any time. Heavy equipment should be used in an area adjacent to the R-Tank system and the material should be moved over the system using tracked equipment with an operating weight of less than 10 tons.  
 M. Typical Applications: Install a 12" or as shown on plans (if) of freely draining material (Section 2.03 B) over the R-Tank Units, maintaining 12" between equipment tracks and R-Tank System. Lightly compact using a walk-behind trench roller. Alternatively, a roller (maximum gross vehicle weight of 6 tons) may be used. Roller must remain in static mode a minimum of 24" of cover has been placed over the modules. Sheep foot rollers should not be used.  
 N. Shadow Applications (1" fill over) install top backfill in accordance with plans.  
 O. Infiltration Applications: Backfill material shall be placed in lifts with a maximum thickness of 12". Each lift shall be placed around the entire perimeter such that each lift is no more than 24" higher than the side backfill along any other location on the perimeter of the R-Tank system. No lift shall be placed over top of tanks until the side backfill has been completed.  
 P. Backfill shall be compacted at the specified moisture content to a minimum of 95% of the Standard Proctor Density until no further densification is observed (for self-compacting stone materials) the side lifts must be compacted with walk behind compaction equipment. Even when "self-compacting" backfill materials are selected, a walk behind vibratory compactor must be used.  
 Q. Take care to ensure that the compaction process does not allow the machinery to come into contact with the modules due to the potential for damage to the geotextile and R-Tank units.  
 R. No compaction equipment is permissible to operate directly on the R-Tank modules.  
 S. Top Backfill: Only low pressure track vehicles shall be operated over the R-Tank system during construction. Dump Trucks and Pans shall not be operated within the R-Tank system footprint at any time. Heavy equipment should be used in an area adjacent to the R-Tank system and the material should be moved over the system using tracked equipment with an operating weight of less than 10 tons.  
 T. Typical Applications: Install a 12" or as shown on plans (if) of freely draining material (Section 2.03 B) over the R-Tank Units, maintaining 12" between equipment tracks and R-Tank System. Lightly compact using a walk-behind trench roller. Alternatively, a roller (maximum gross vehicle weight of 6 tons) may be used. Roller must remain in static mode a minimum of 24" of cover has been placed over the modules. Sheep foot rollers should not be used.  
 U. Shadow Applications (1" fill over) install top backfill in accordance with plans.  
 V. Infiltration Applications: Backfill material shall be placed in lifts with a maximum thickness of 12". Each lift shall be placed around the entire perimeter such that each lift is no more than 24" higher than the side backfill along any other location on the perimeter of the R-Tank system. No lift shall be placed over top of tanks until the side backfill has been completed.  
 W. Backfill shall be compacted at the specified moisture content to a minimum of 95% of the Standard Proctor Density until no further densification is observed (for self-compacting stone materials) the side lifts must be compacted with walk behind compaction equipment. Even when "self-compacting" backfill materials are selected, a walk behind vibratory compactor must be used.  
 X. Take care to ensure that the compaction process does not allow the machinery to come into contact with the modules due to the potential for damage to the geotextile and R-Tank units.  
 Y. No compaction equipment is permissible to operate directly on the R-Tank modules.  
 Z. Top Backfill: Only low pressure track vehicles shall be operated over the R-Tank system during construction. Dump Trucks and Pans shall not be operated within the R-Tank system footprint at any time. Heavy equipment should be used in an area adjacent to the R-Tank system and the material should be moved over the system using tracked equipment with an operating weight of less than 10 tons.

3.06 MAINTENANCE REQUIREMENTS  
 A. Routine maintenance effort is required to ensure proper performance of the R-Tank system. The Maintenance program should be based on pretreatment systems. Ensuring these structures are clean and functioning properly will reduce the risk of contamination of the R-Tank system and stormwater released from the site. The treatment systems shall be inspected yearly, or as directed by the regulatory agency and by the manufacturer (for proprietary systems). Maintain as needed using acceptable practices or following manufacturer's guidelines (for proprietary systems).  
 B. All inlet pipes and Inspection and/or Maintenance Ports in the R-Tank system will need to be inspected for accumulation of sediments at least quarterly through the first year of operation and at least yearly thereafter.  
 C. If sediment has accumulated to the level noted in the R-Tank Maintenance Guide or beyond a level acceptable to the Owner's engineer, the R-Tank system should be flushed.  
 D. All inspection and maintenance activities should be performed in accordance with the R-Tank Operation, Inspection & Maintenance Manual.

811  
 Know what's below.  
 Call before you dig.



# EAST TOWN CROSSING PHASE 1



## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED

BY: *[Signature]*  
CITY OF PUYALLUP  
DEVELOPMENT ENGINEERING

DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

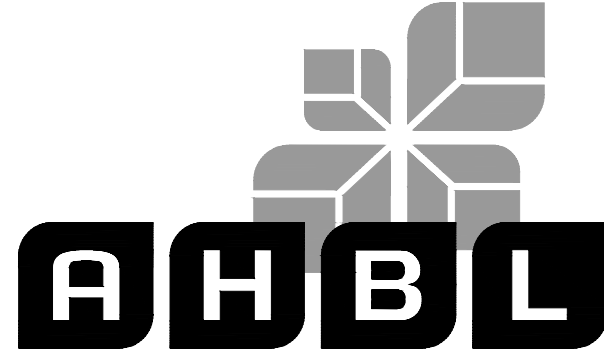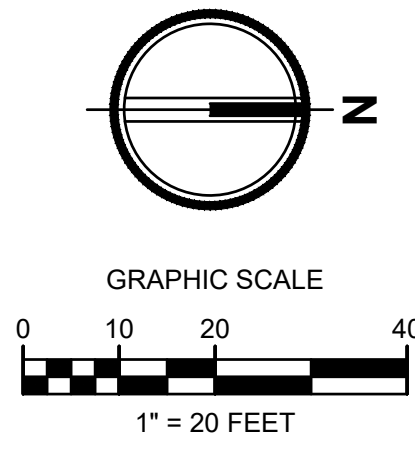

TACOMA • SEATTLE • SPOKANE • TRI-CITIES

2215 North 30th Street, Suite 300, Tacoma, WA 98403  
253.383.2422 TEL. 253.383.2572 FAX www.ahbl.com WEB

Project Title:

### EAST TOWN CROSSING PHASE 1

Client:

ASH DEVELOPMENT

GREG HELLE

GREG.HELLE@ASHNW.COM


Project No.

2230752

Issue Set & Date:

### PERMIT SUBMITTAL

05/17/2024

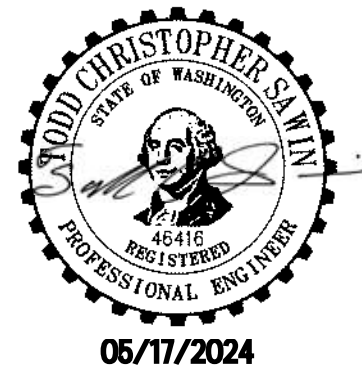

NOTICE: ALLEGATIONS OF THIS DOCUMENT SHALL INDICATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A PROFESSIONAL ENGINEER'S CERTIFICATION OF THE ACCURACY OF THE INFORMATION CONTAINED HEREIN. THE ENGINEER OR ARCHITECT IS NOT TO BE USED FOR ANY OTHER PROJECT, OR ADDITION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

▲

▲

▲ 03/29/24 CITY COMMENTS

▲ 01/29/24 CITY COMMENTS

Revisions:

Sheet Title:


### SEWER PLAN NW

Designed by: CW    Drawn by: SK / RS    Checked by: JI

Sheet No.

### C5.01

34 of 53 Sheets

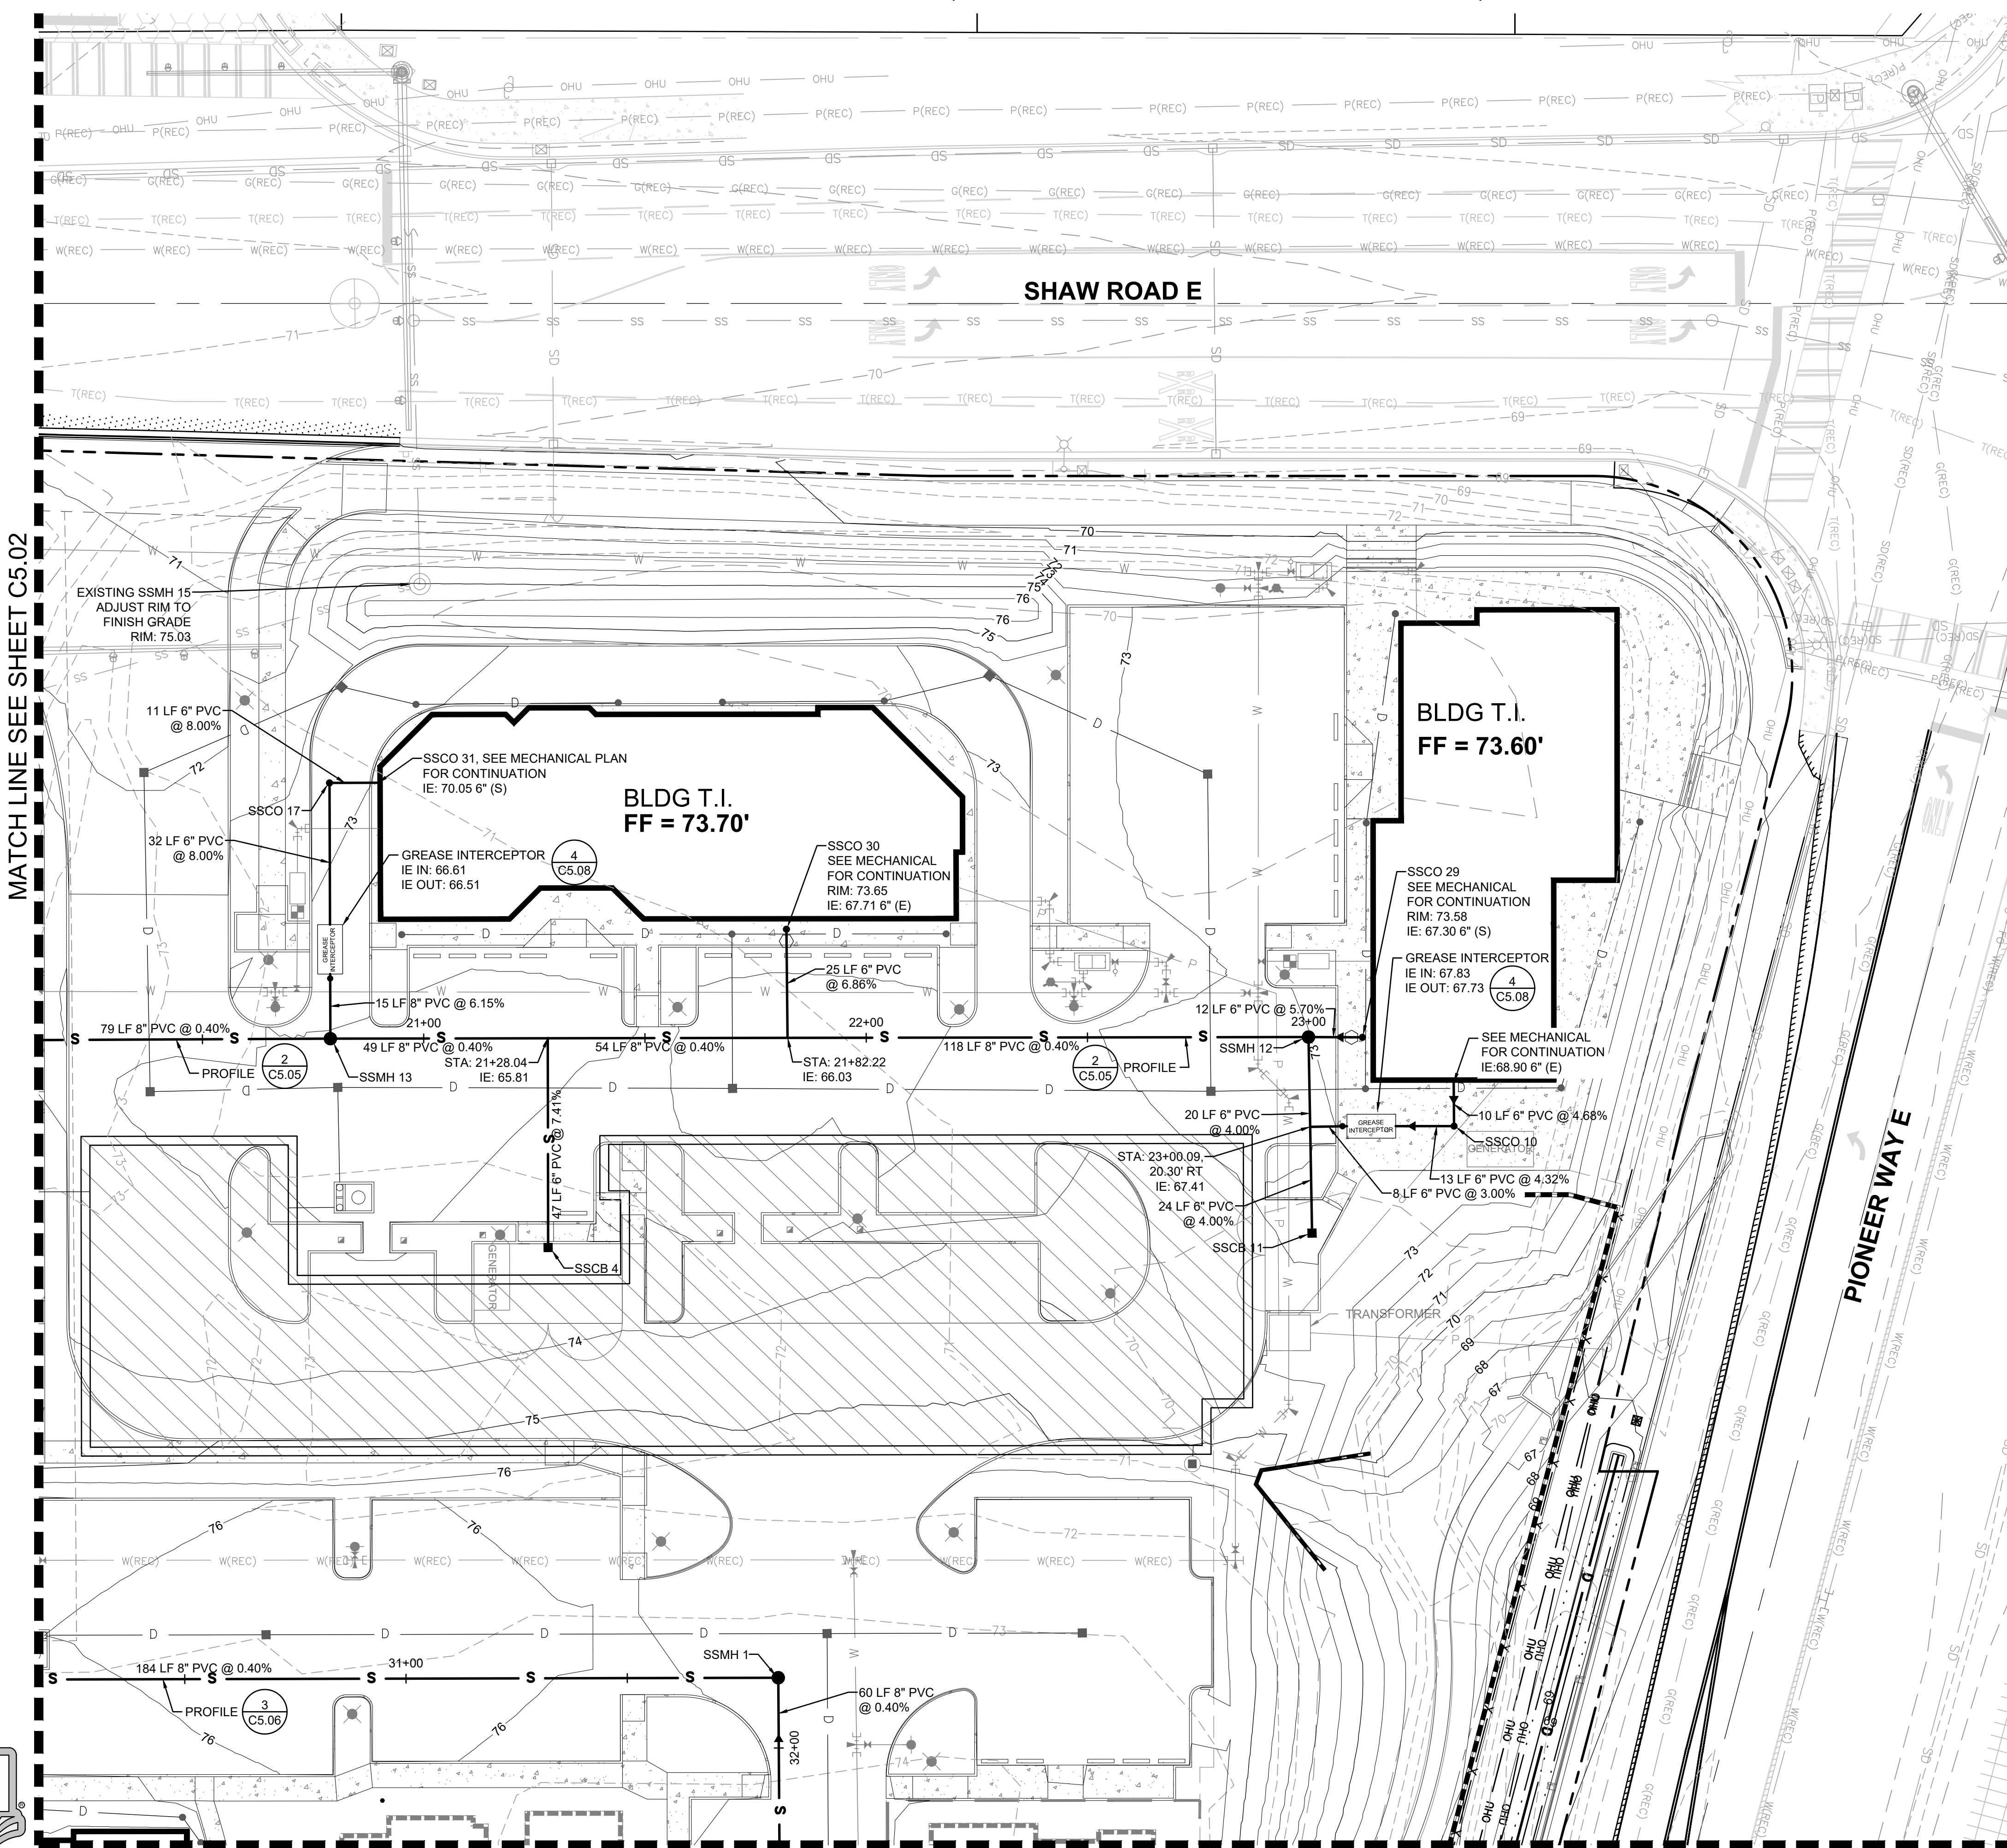


#### LEGEND

- RIGHT-OF-WAY / PROPERTY LINE
- CENTERLINE
- - - EASEMENT
- BUILDING OUTLINE
- S — SANITARY SIDE SEWER
- S — SANITARY SEWER MAIN
- FM — SANITARY SEWER FORCE MAIN
- — SANITARY SEWER CLEANOUT
- — SAMPLING CONNECTION
- — SANITARY SEWER MANHOLE
- 123 — PROPOSED MINOR CONTOUR
- 123 — PROPOSED MAJOR CONTOUR

#### SEWER STRUCTURE TABLE

STRUCTURE NAME	STRUCTURE DETAILS
EXISTING SSMH 15 ADJUST RIM TO FINISH GRADE	RIM = 75.03 IE = 50.82 (8" W) IE = 62.37 (8" S) INSIDE DROP MH E 1203825.42
SSCB 4 TYPE 1 CB	RIM = 73.25 IE = 69.31 (6" W)
SSCB 11 TYPE 1 CB	RIM = 72.79 IE = 68.37 (6" W)
SSCO 10	RIM = 73.55 IE = 68.33 (6" S) IE = 68.43 (6" W)
SSCO 17	RIM = 72.81 IE = 69.17 (6" E) IE = 69.17 (6" N)
SSMH 1 48" SSMH	RIM = 75.64 IE = 66.61 (8" S) IE = 66.71 (8" E)
SSMH 12 48" SSMH	RIM = 72.99 IE = 66.50 (8" S) IE = 66.50 (6" E) IE = 66.60 (6" N)
SSMH 13 48" SSMH	RIM = 72.88 IE = 65.51 (8" S) IE = 65.61 (8" N) IE = 65.61 (8" W)

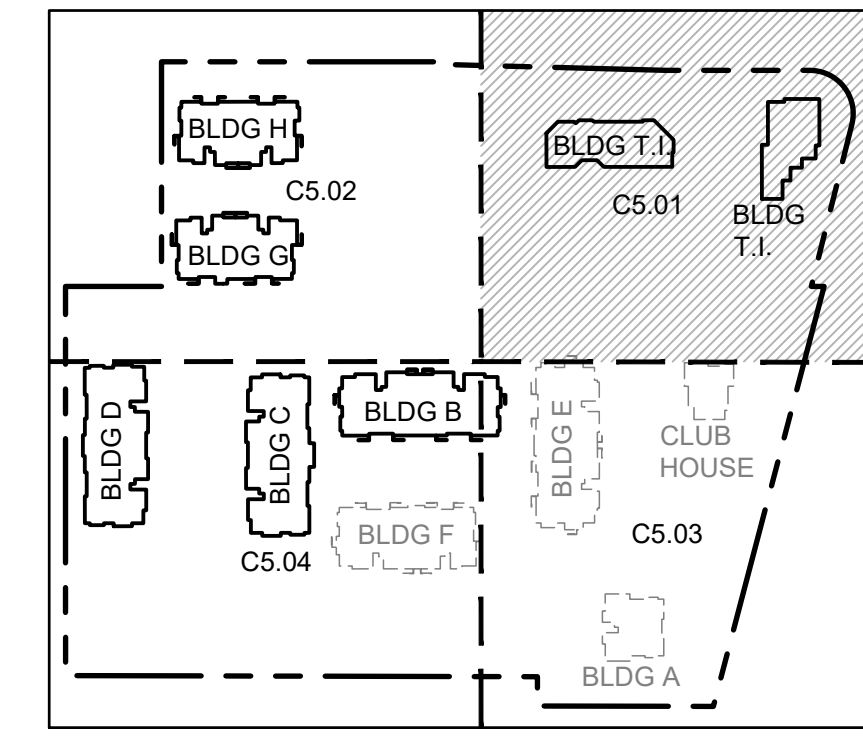

MATCH LINE SEE SHEET C5.02

MATCH LINE SEE SHEET C5.03



Know what's below.  
Call before you dig.




# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024



NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

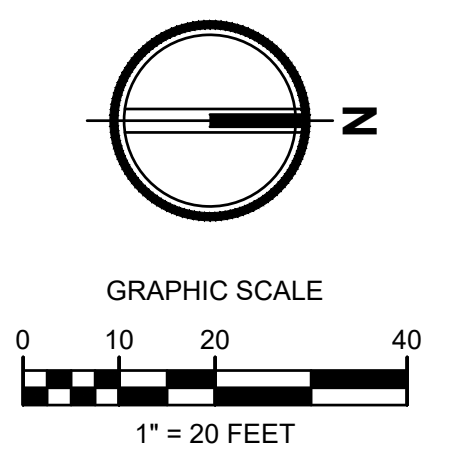

**LEGEND**

- RIGHT-OF-WAY / PROPERTY LINE
- - - CENTERLINE
- - - EASEMENT
- BUILDING OUTLINE
- S SANITARY SIDE SEWER
- S SANITARY SEWER MAIN
- FM SANITARY SEWER FORCE MAIN
- SANITARY SEWER CLEANOUT
- SAMPLING CONNECTION
- SANITARY SEWER MANHOLE
- 123 PROPOSED MINOR CONTOUR
- 123 PROPOSED MAJOR CONTOUR

STRUCTURE NAME	STRUCTURE DETAILS
EXISTING SSMH 14 ADJUST RIM TO FINISH GRADE N 679810.64 E 1203854.27	RIM = 76.74 IE = 64.46 (8" N) IE = 64.80 (8" E)
SSCO 5 TYPE 1 CB N 679490.51 E 1204032.97	RIM = 75.95 IE = 71.01 (6" E)
SSCO 7	RIM = 76.68 IE = 67.73 (8" N)
SSCO 18	RIM = 76.18 IE = 69.71 (6" W) IE = 69.71 (6" W)
SSMH 2 48" TYPE 1 N 679814.92 E 1204071.02	RIM = 76.75 IE = 65.77 (8" W) IE = 65.90 (6" E) IE = 65.87 (8" S) IE = 65.87 (8" N)
SSMH 3 48" TYPE 1 N 679821.72 E 1203926.62	RIM = 76.14 IE = 65.09 (8" W) IE = 65.19 (8" E) IE = 65.19 (8" N)
SSMH 6 48" SSMH N 679540.98 E 1204066.28	RIM = 76.03 IE = 69.10 (8" N) IE = 69.20 (8" E) IE = 69.20 (6" S)
SSMH 8 48" TYPE 1 N 679669.99 E 1203916.83	RIM = 77.24 IE = 67.17 (8" E) IE = 67.27 (8" S)
SSMH 9 48" TYPE 1 N 679667.05 E 1204068.46	RIM = 76.63 IE = 66.46 (8" N) IE = 66.56 (8" S) IE = 66.56 (8" W)

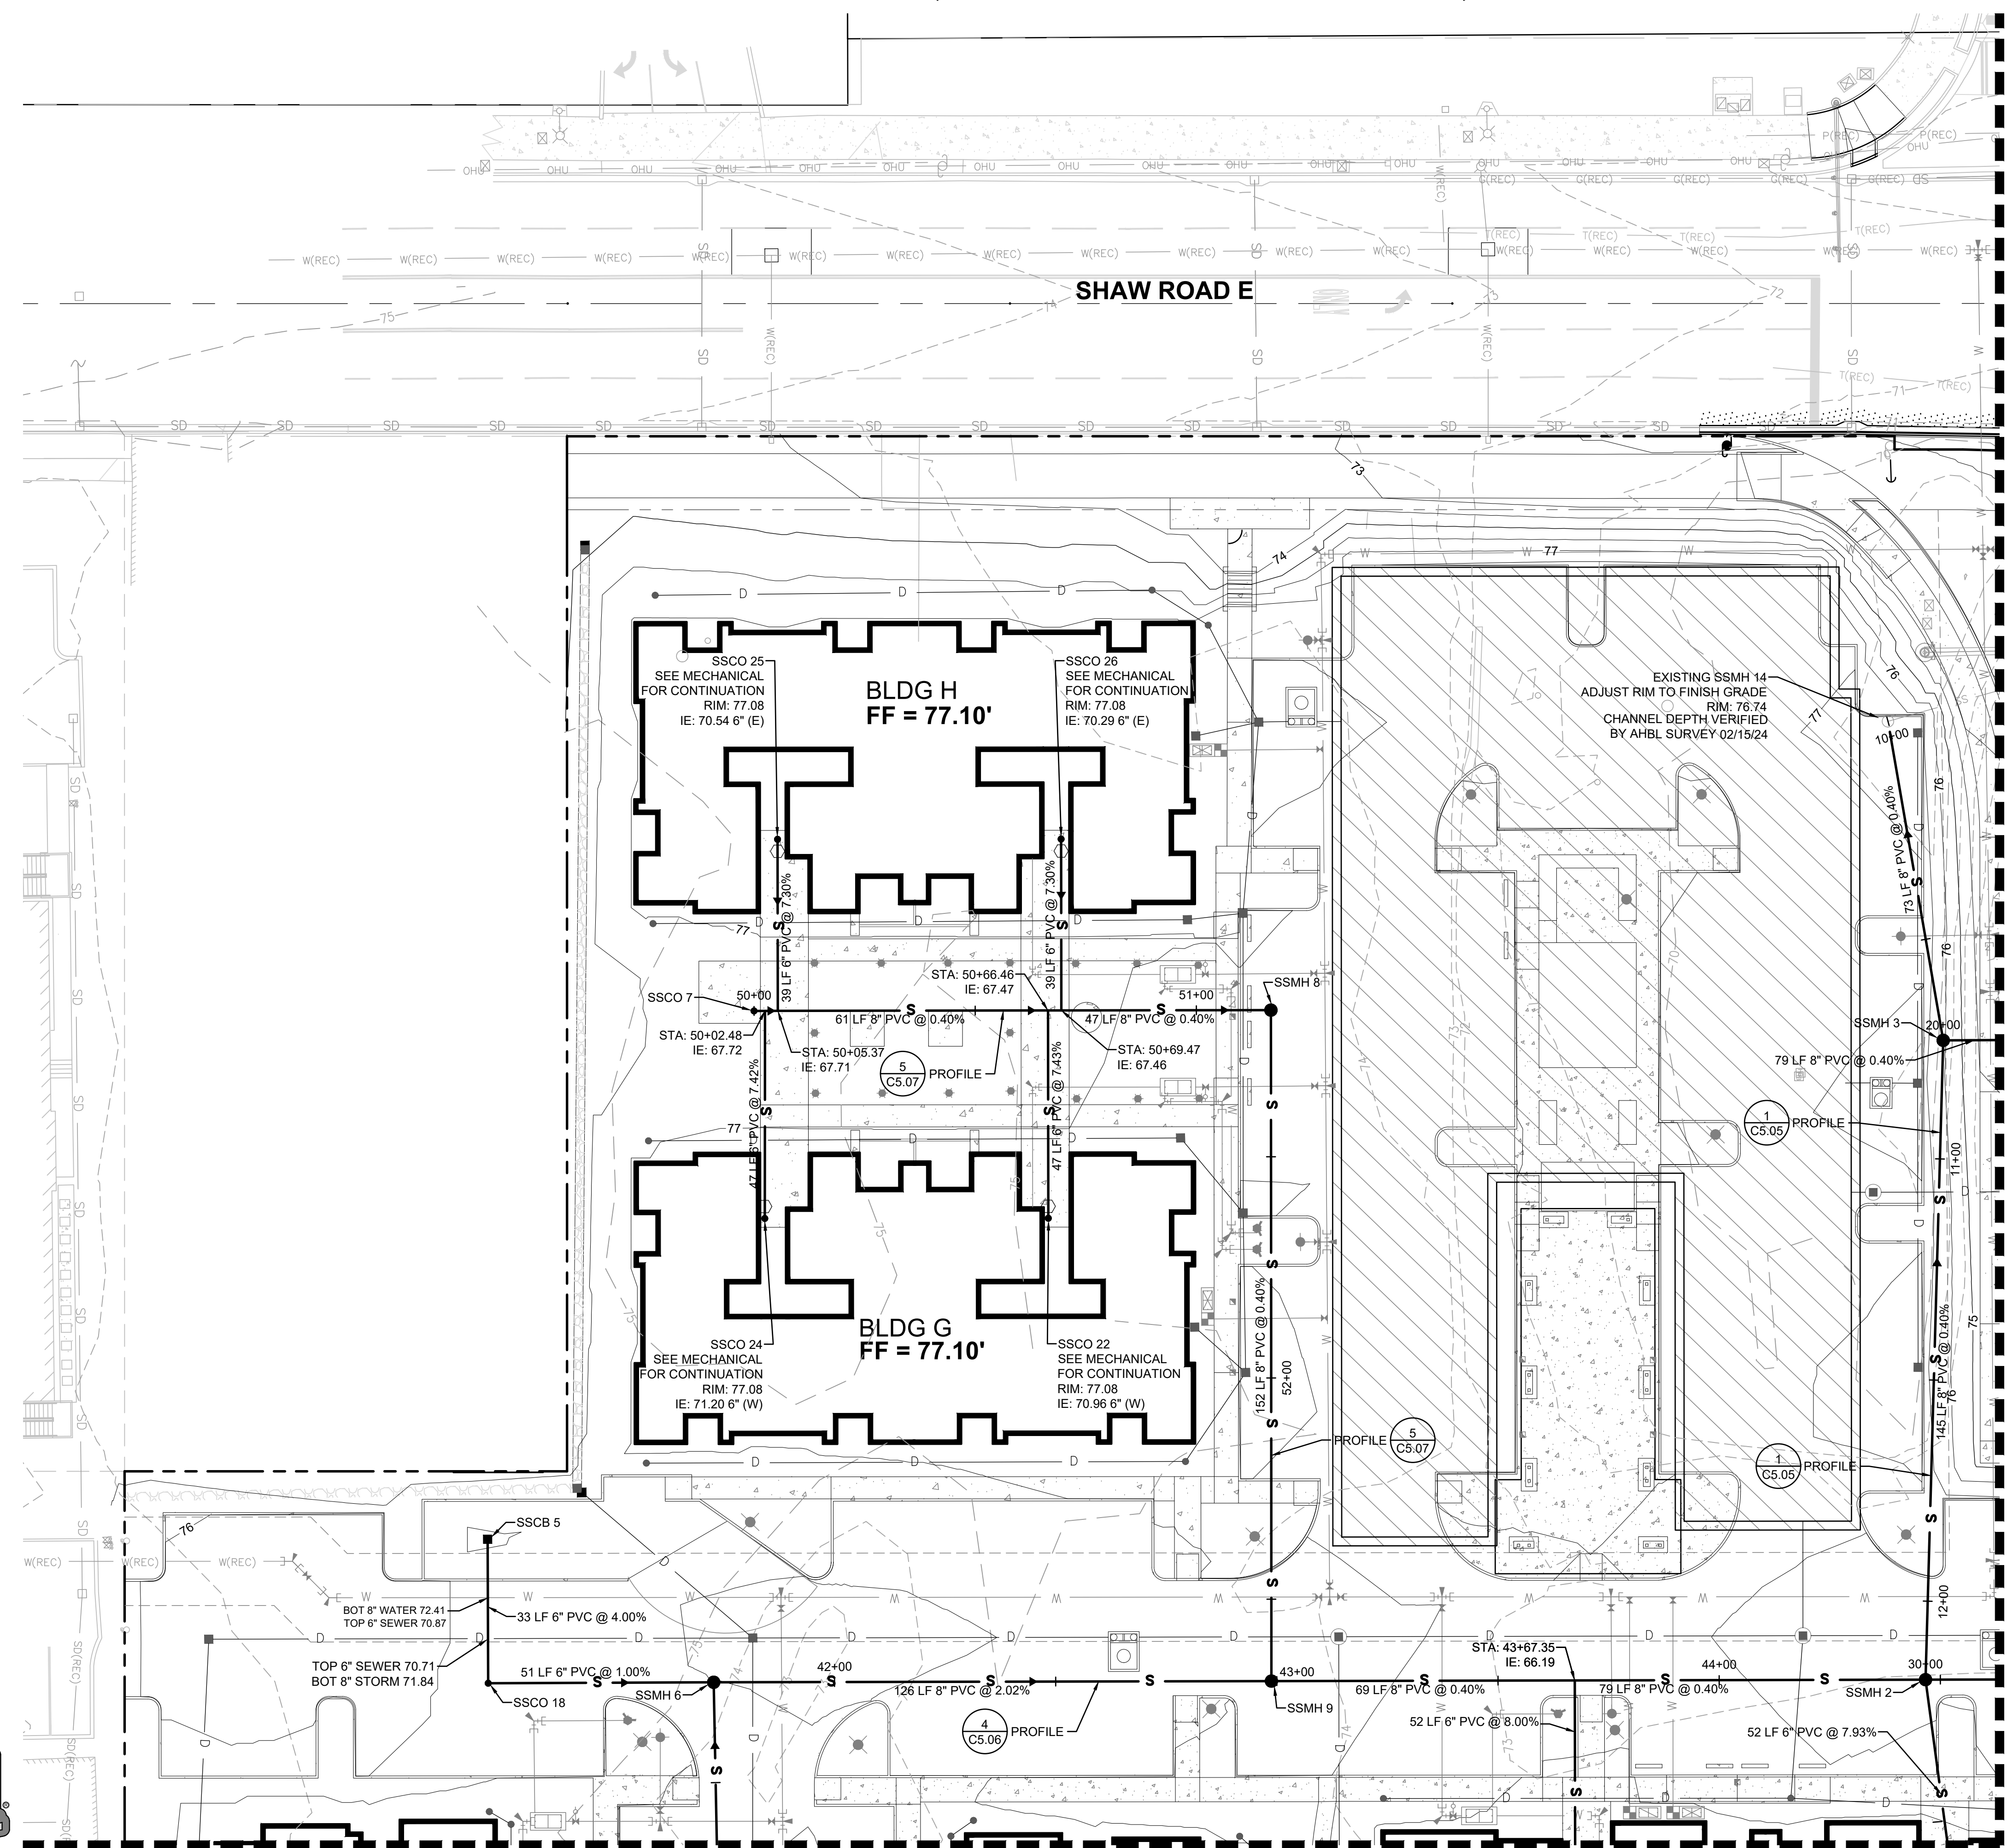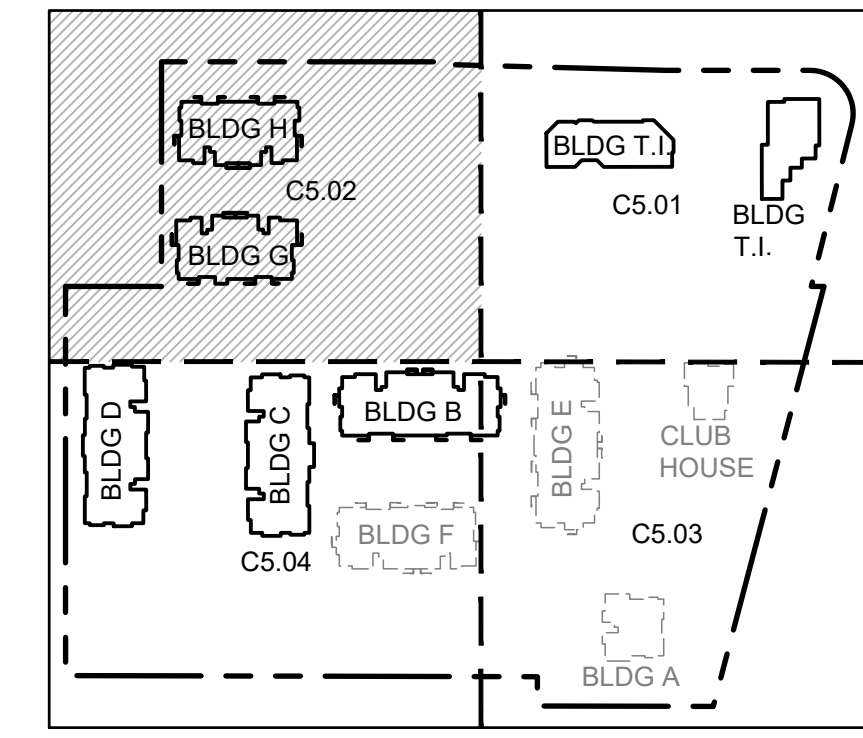

MATCH LINE SEE SHEET C5.01

MATCH LINE SEE SHEET C5.04

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
**ASH DEVELOPMENT**

Greg Helle  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE: ALTERATION OF THIS DOCUMENT SHALL VIOLATE THE PROFESSIONAL SEAL AND SIGNATURE PROVISIONS OF THE WASHINGTON RULES OF PROFESSIONAL CONDUCT. THIS DOCUMENT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT PERMISSION IN WRITING FROM THE ENGINEER OR ARCHITECT. THIS NOTICE IS NOT TO BE USED FOR MARKETING OR ADVERTISING PURPOSES.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Sheet Title:  
**SEWER PLAN SW**

Designed by: CW    Drawn by: SK/RS    Checked by: JI

Sheet No.  
**C5.02**






# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

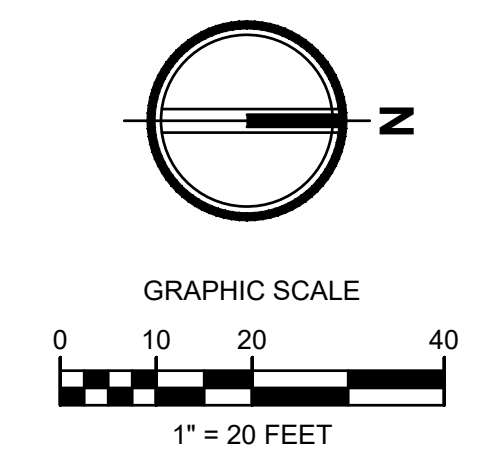

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT


GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 04/09/2024

**LEGEND**

---	RIGHT-OF-WAY / PROPERTY LINE
---	CENTERLINE
---	EASEMENT
---	BUILDING OUTLINE
S	SANITARY SIDE SEWER
S	SANITARY SEWER MAIN
FM	SANITARY SEWER FORCE MAIN
○	SANITARY SEWER CLEANOUT
○	SAMPLING CONNECTION
●	SANITARY SEWER MANHOLE
---	PROPOSED MINOR CONTOUR
---	PROPOSED MAJOR CONTOUR

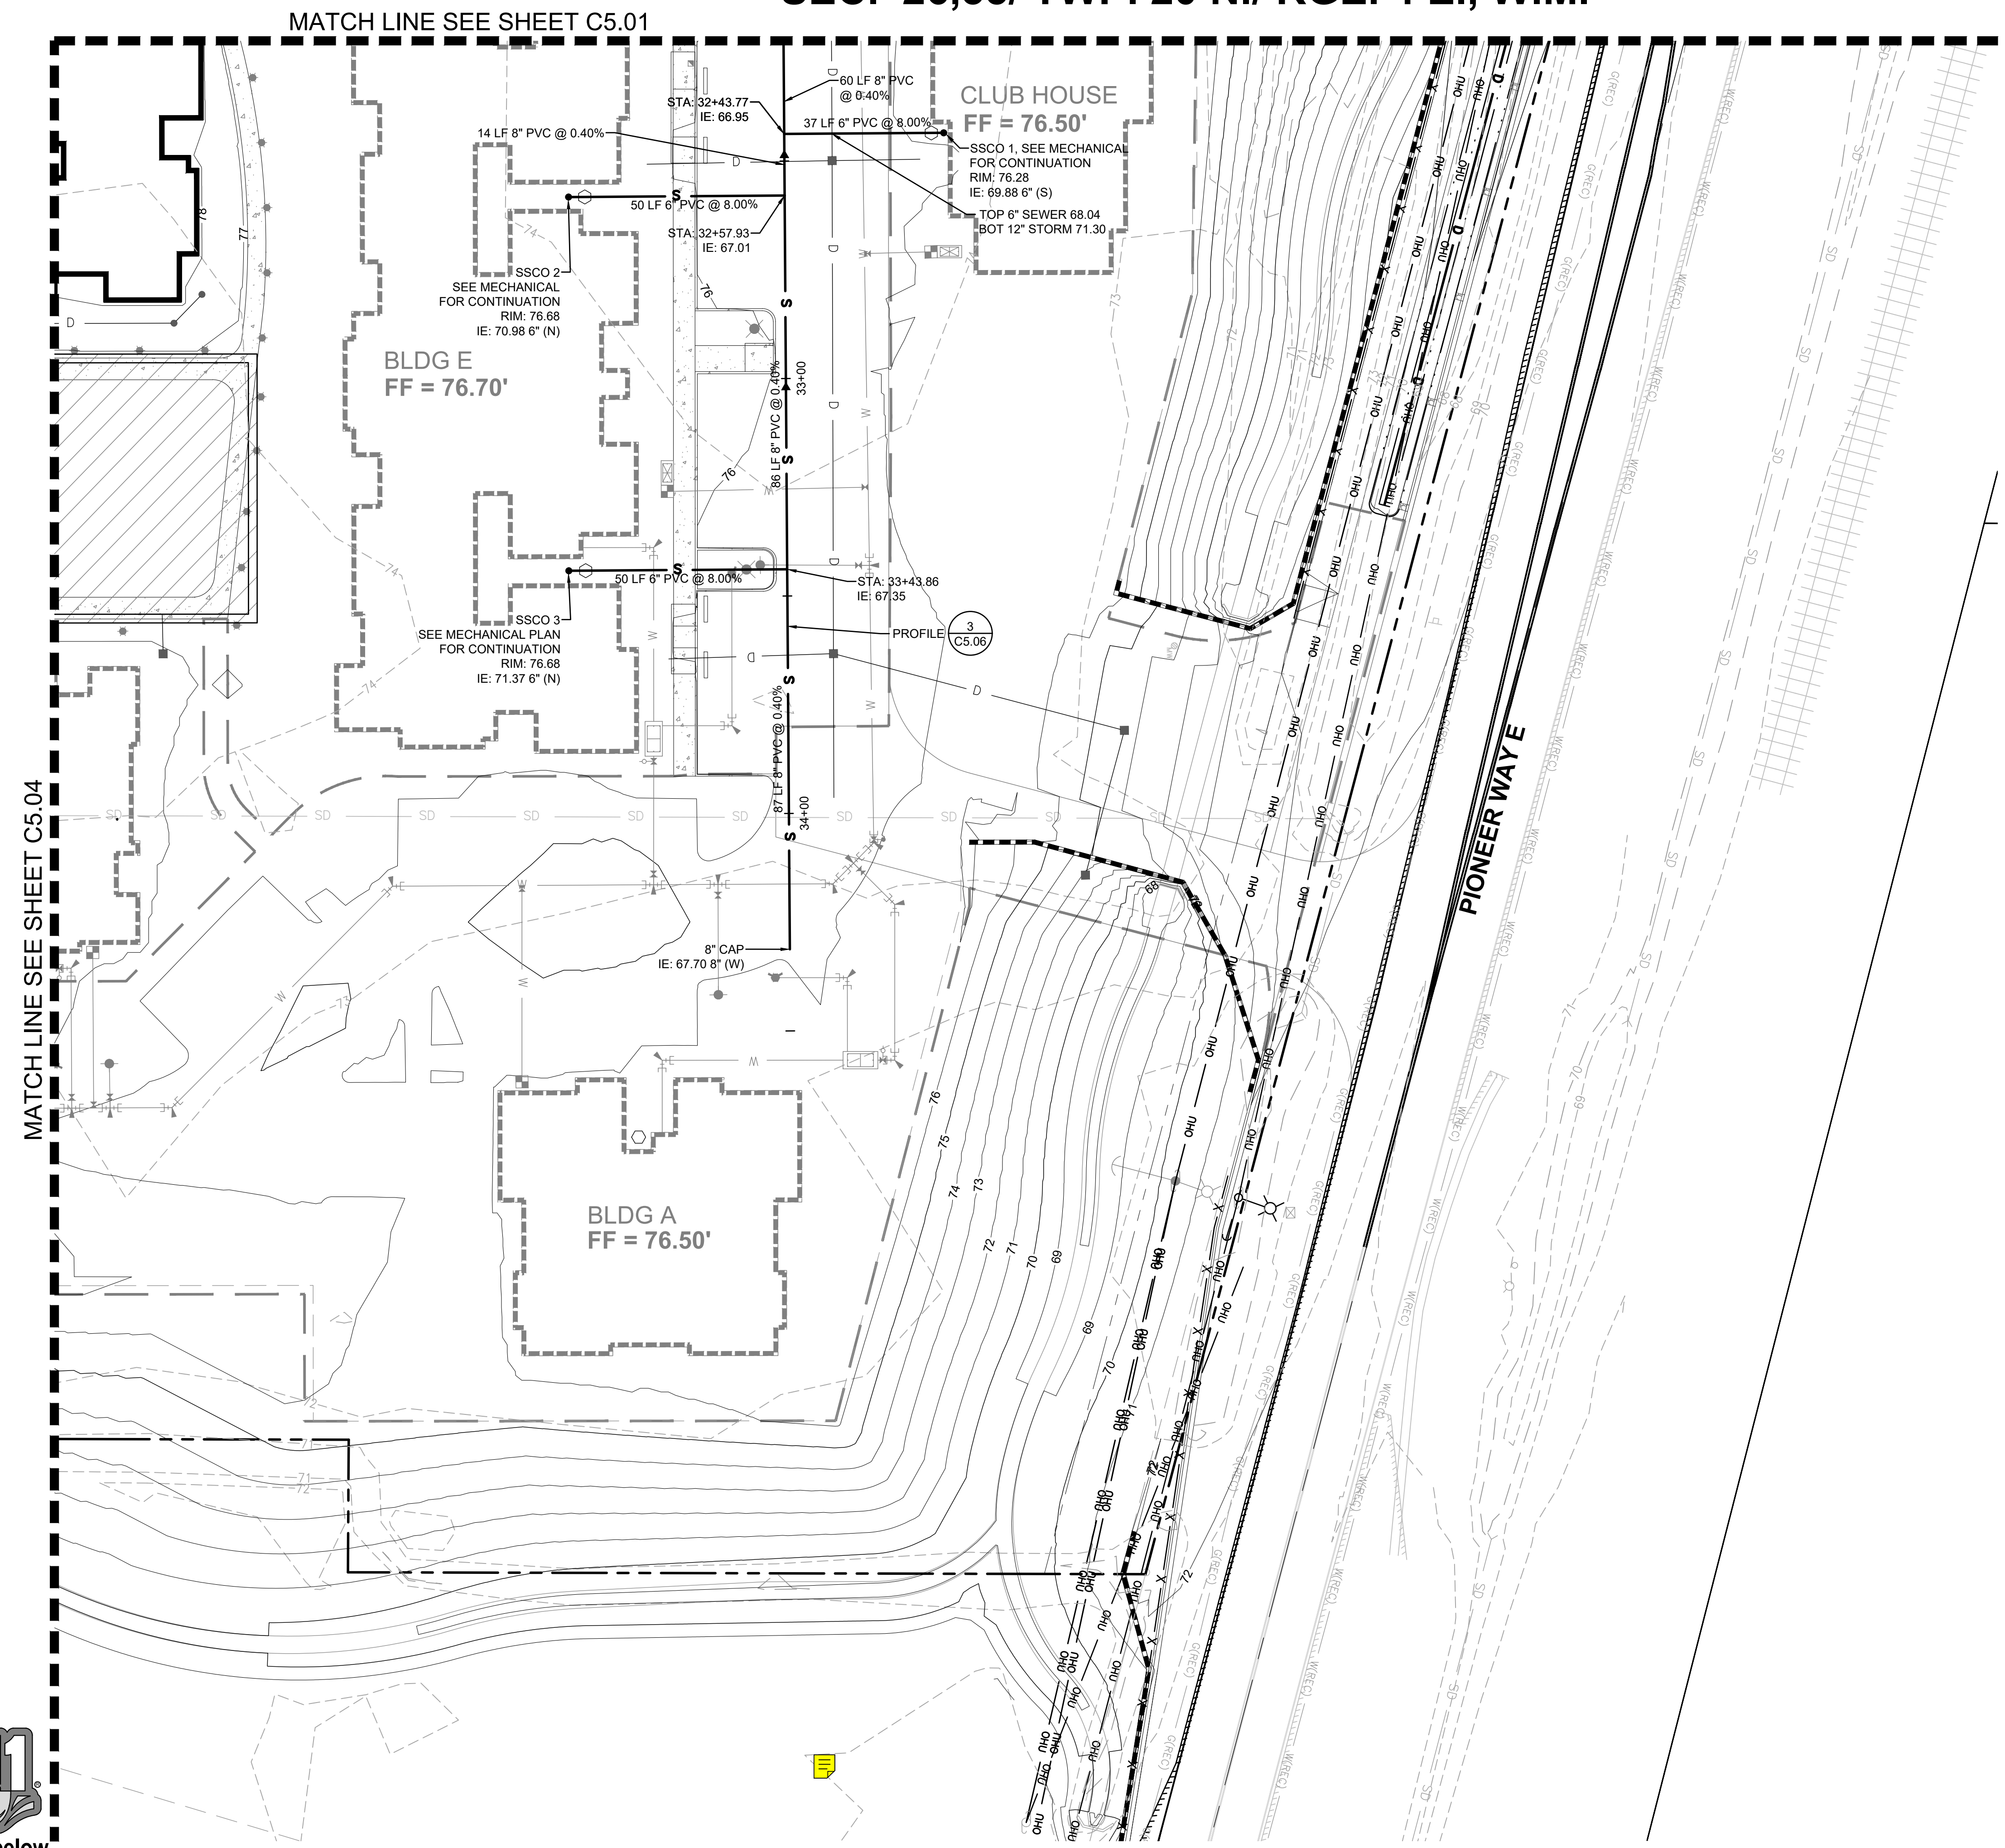

NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE AN ENDORSEMENT OR GUARANTEE BY THE ENGINEER OR ARCHITECT. THIS DOCUMENT IS TO BE USED ONLY FOR THE PROJECT DESCRIBED IN THE TITLE BLOCK AND IS NOT TO BE USED FOR ANY OTHER PROJECT OR IN CONNECTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.


City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

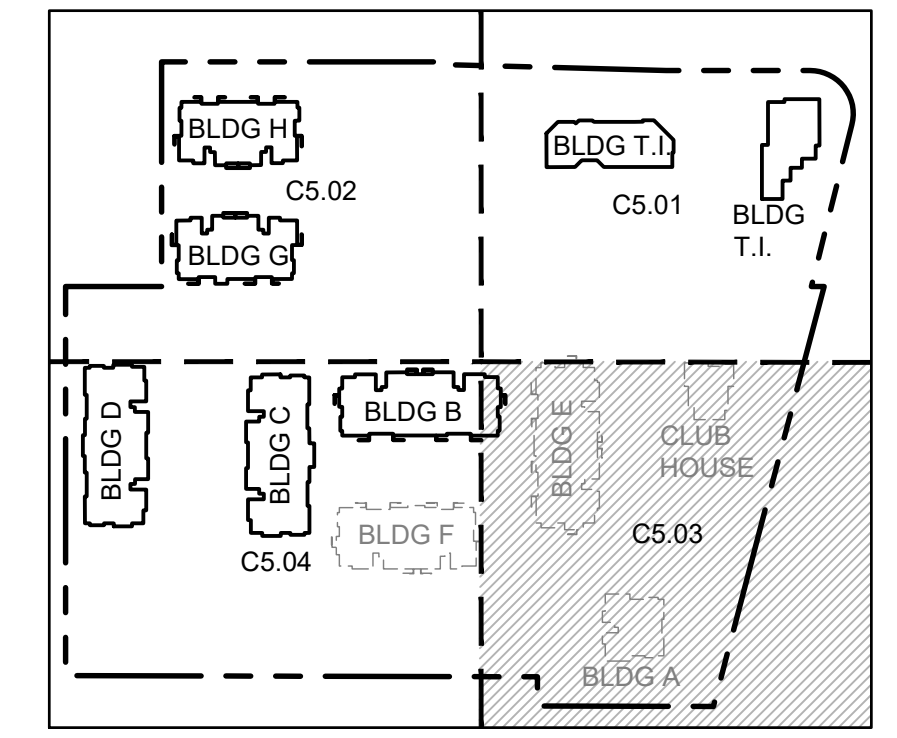

Sheet Title:  
**SEWER PLAN NE**

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C5.03**  
 36 of 53 Sheets





# EAST TOWN CROSSING PHASE 1


## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

**APPROVED**

BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING

DATE: 06/06/2024


NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

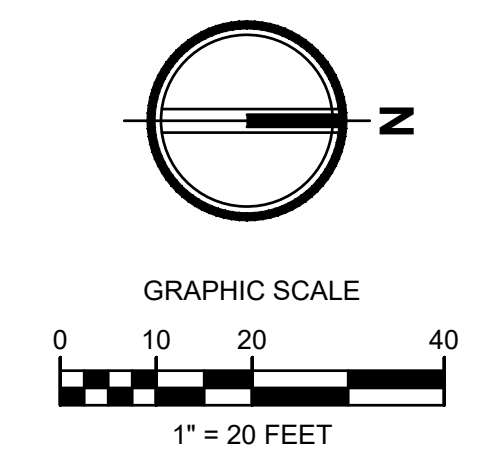

**AHBL**

TACOMA • SEATTLE • SPOKANE • TRI-CITIES

2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

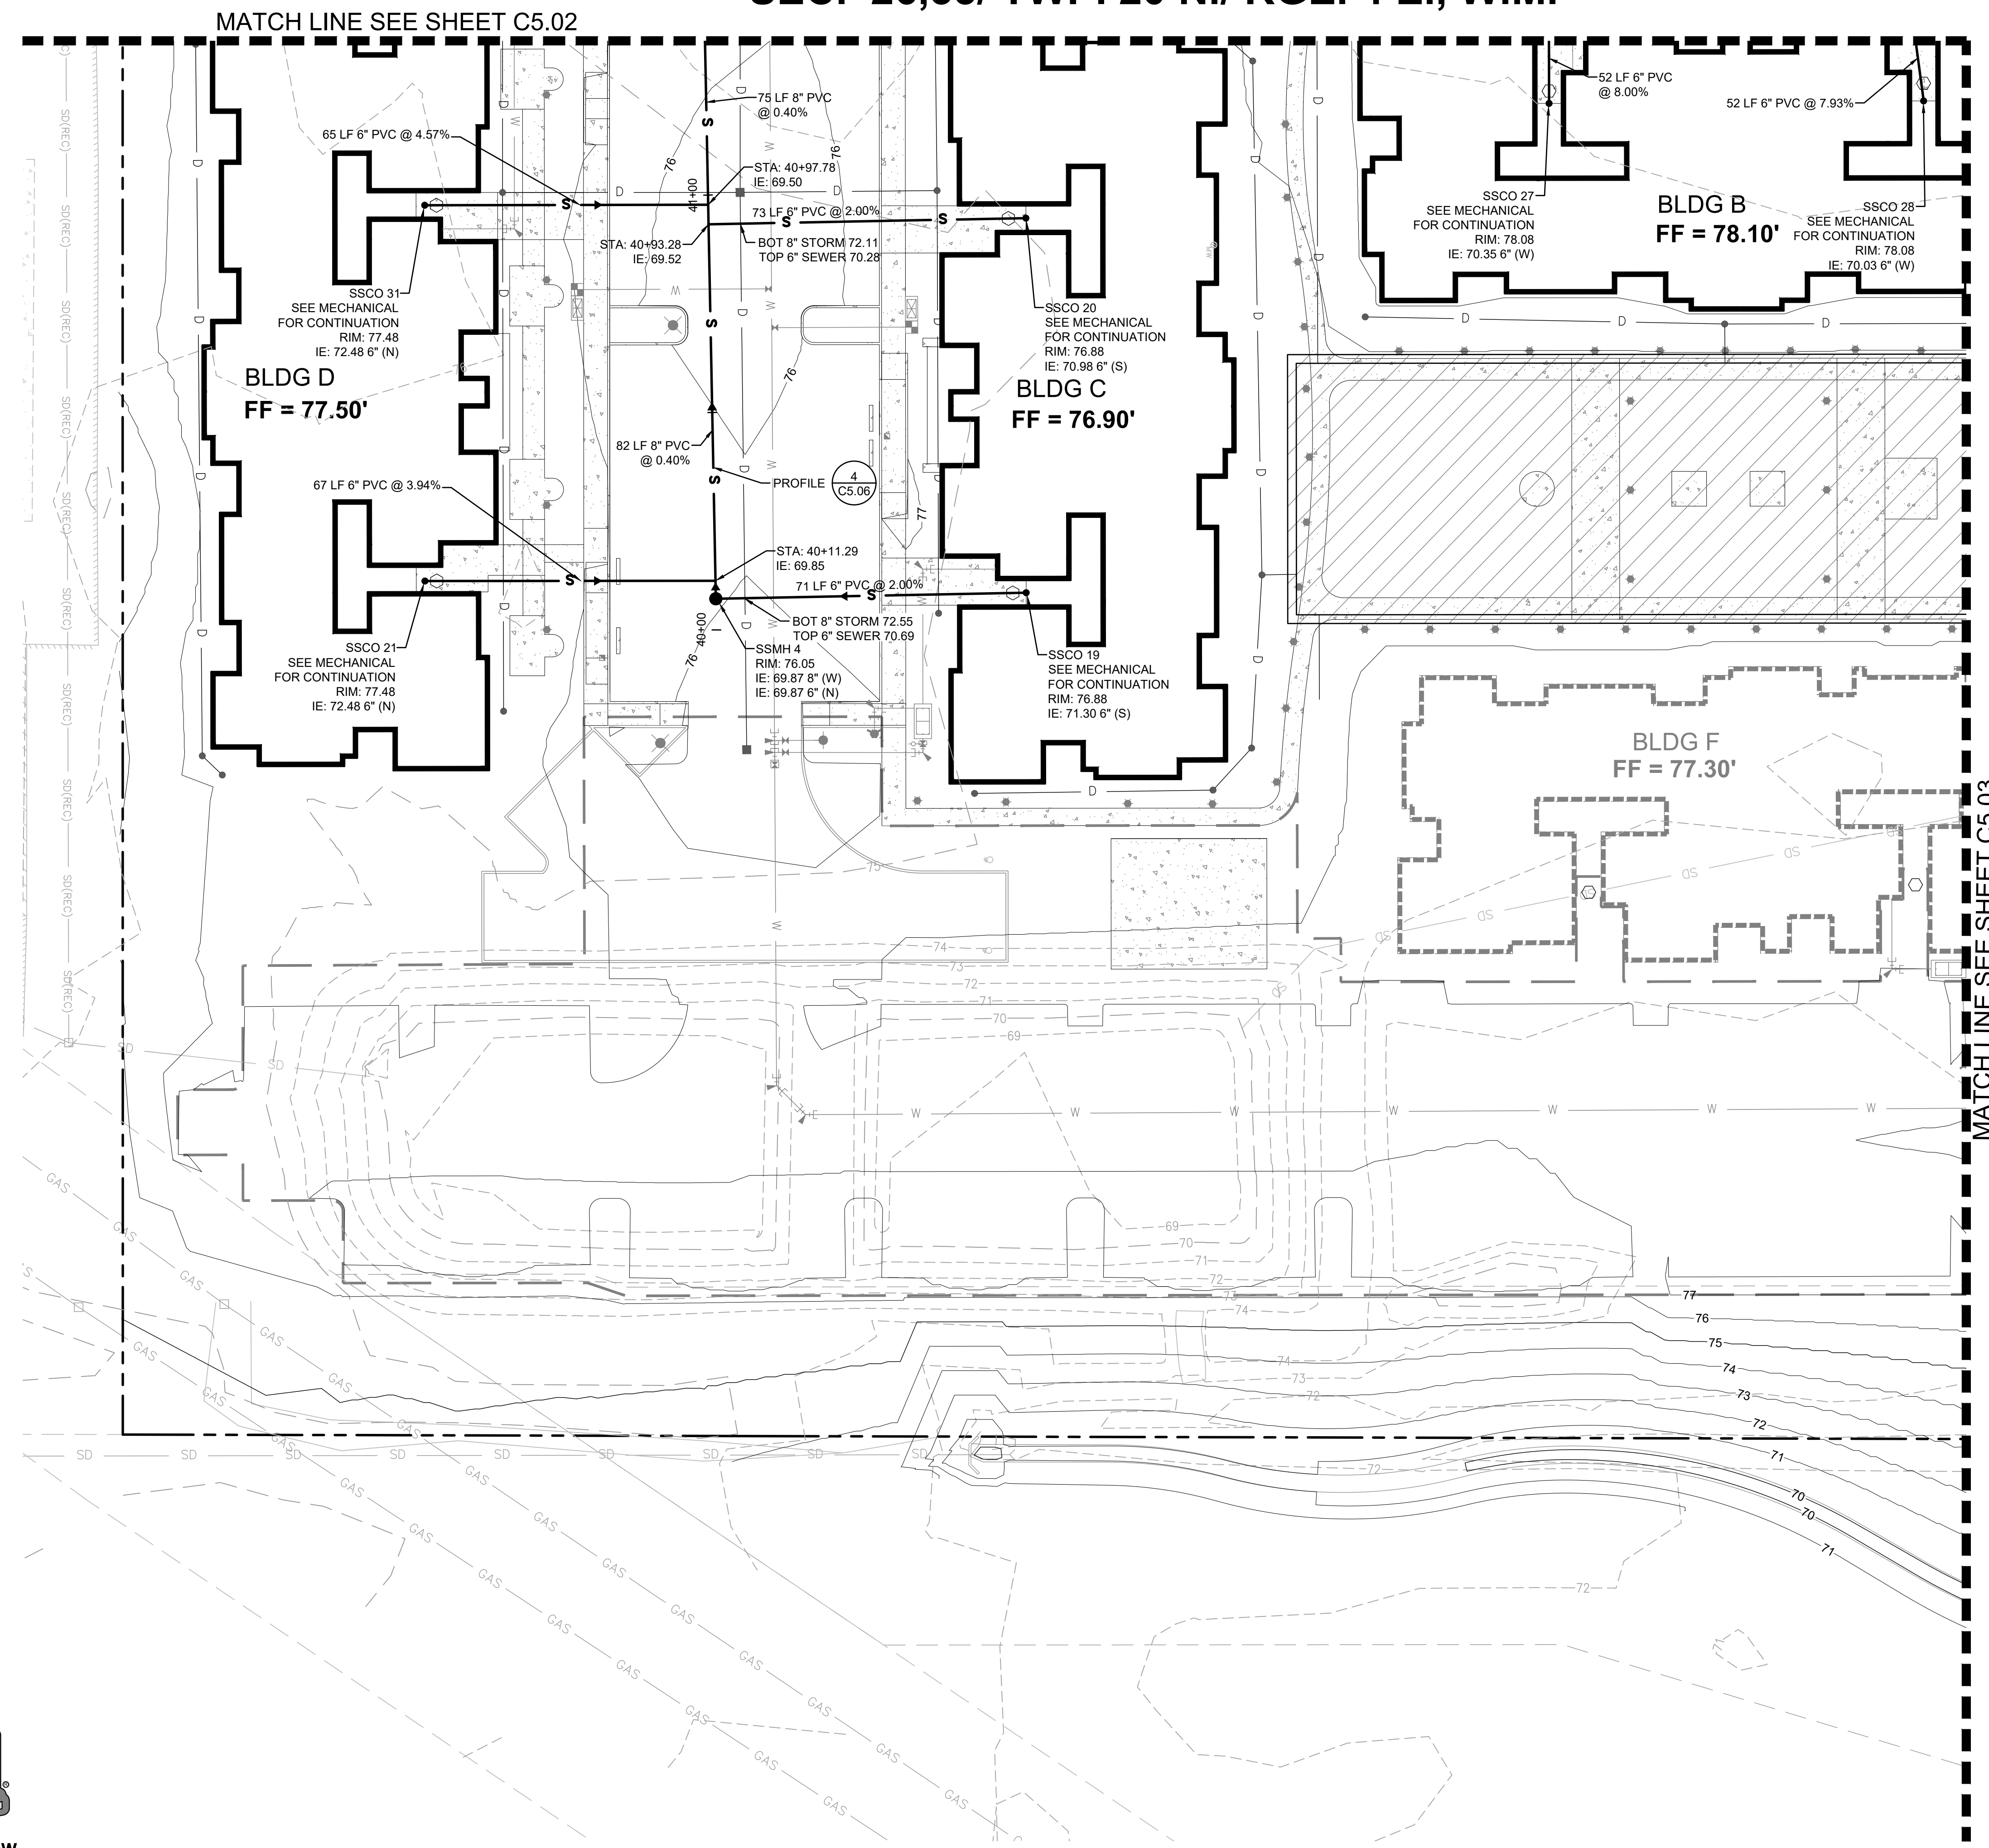

**LEGEND**

	RIGHT-OF-WAY / PROPERTY LINE
	CENTERLINE
	EASEMENT
	BUILDING OUTLINE
	SANITARY SIDE SEWER
	SANITARY SEWER MAIN
	SANITARY SEWER FORCE MAIN
	SANITARY SEWER CLEANOUT
	SAMPLING CONNECTION
	SANITARY SEWER MANHOLE
	PROPOSED MINOR CONTOUR
	PROPOSED MAJOR CONTOUR

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
**ASH DEVELOPMENT**

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 04/09/2024



NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OR WARRANTY BY THE ENGINEER OR ARCHITECT. THE ENGINEER OR ARCHITECT IS NOT TO BE USED FOR ANY OTHER PROJECT OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.


**City of Puyallup  
 Development & Permitting Services  
 ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

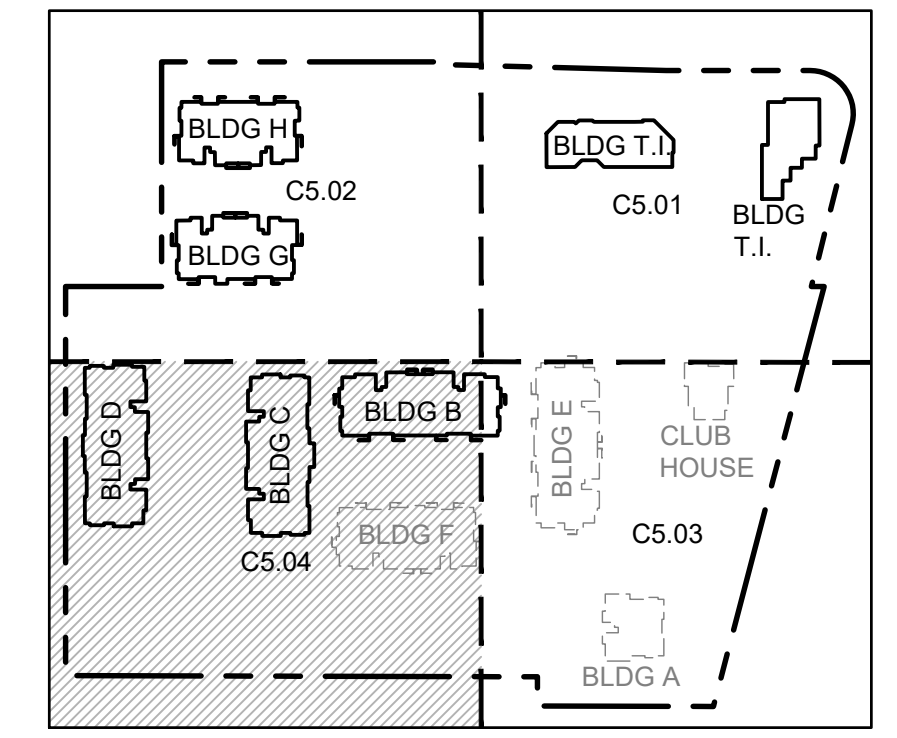

Sheet Title:  
**SEWER PLAN SE**

Designed by: CW    Drawn by: SK / RS    Checked by: JI

Sheet No.  
**C5.04**  
 37 of 53 Sheets






# EAST TOWN CROSSING PHASE 1


## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

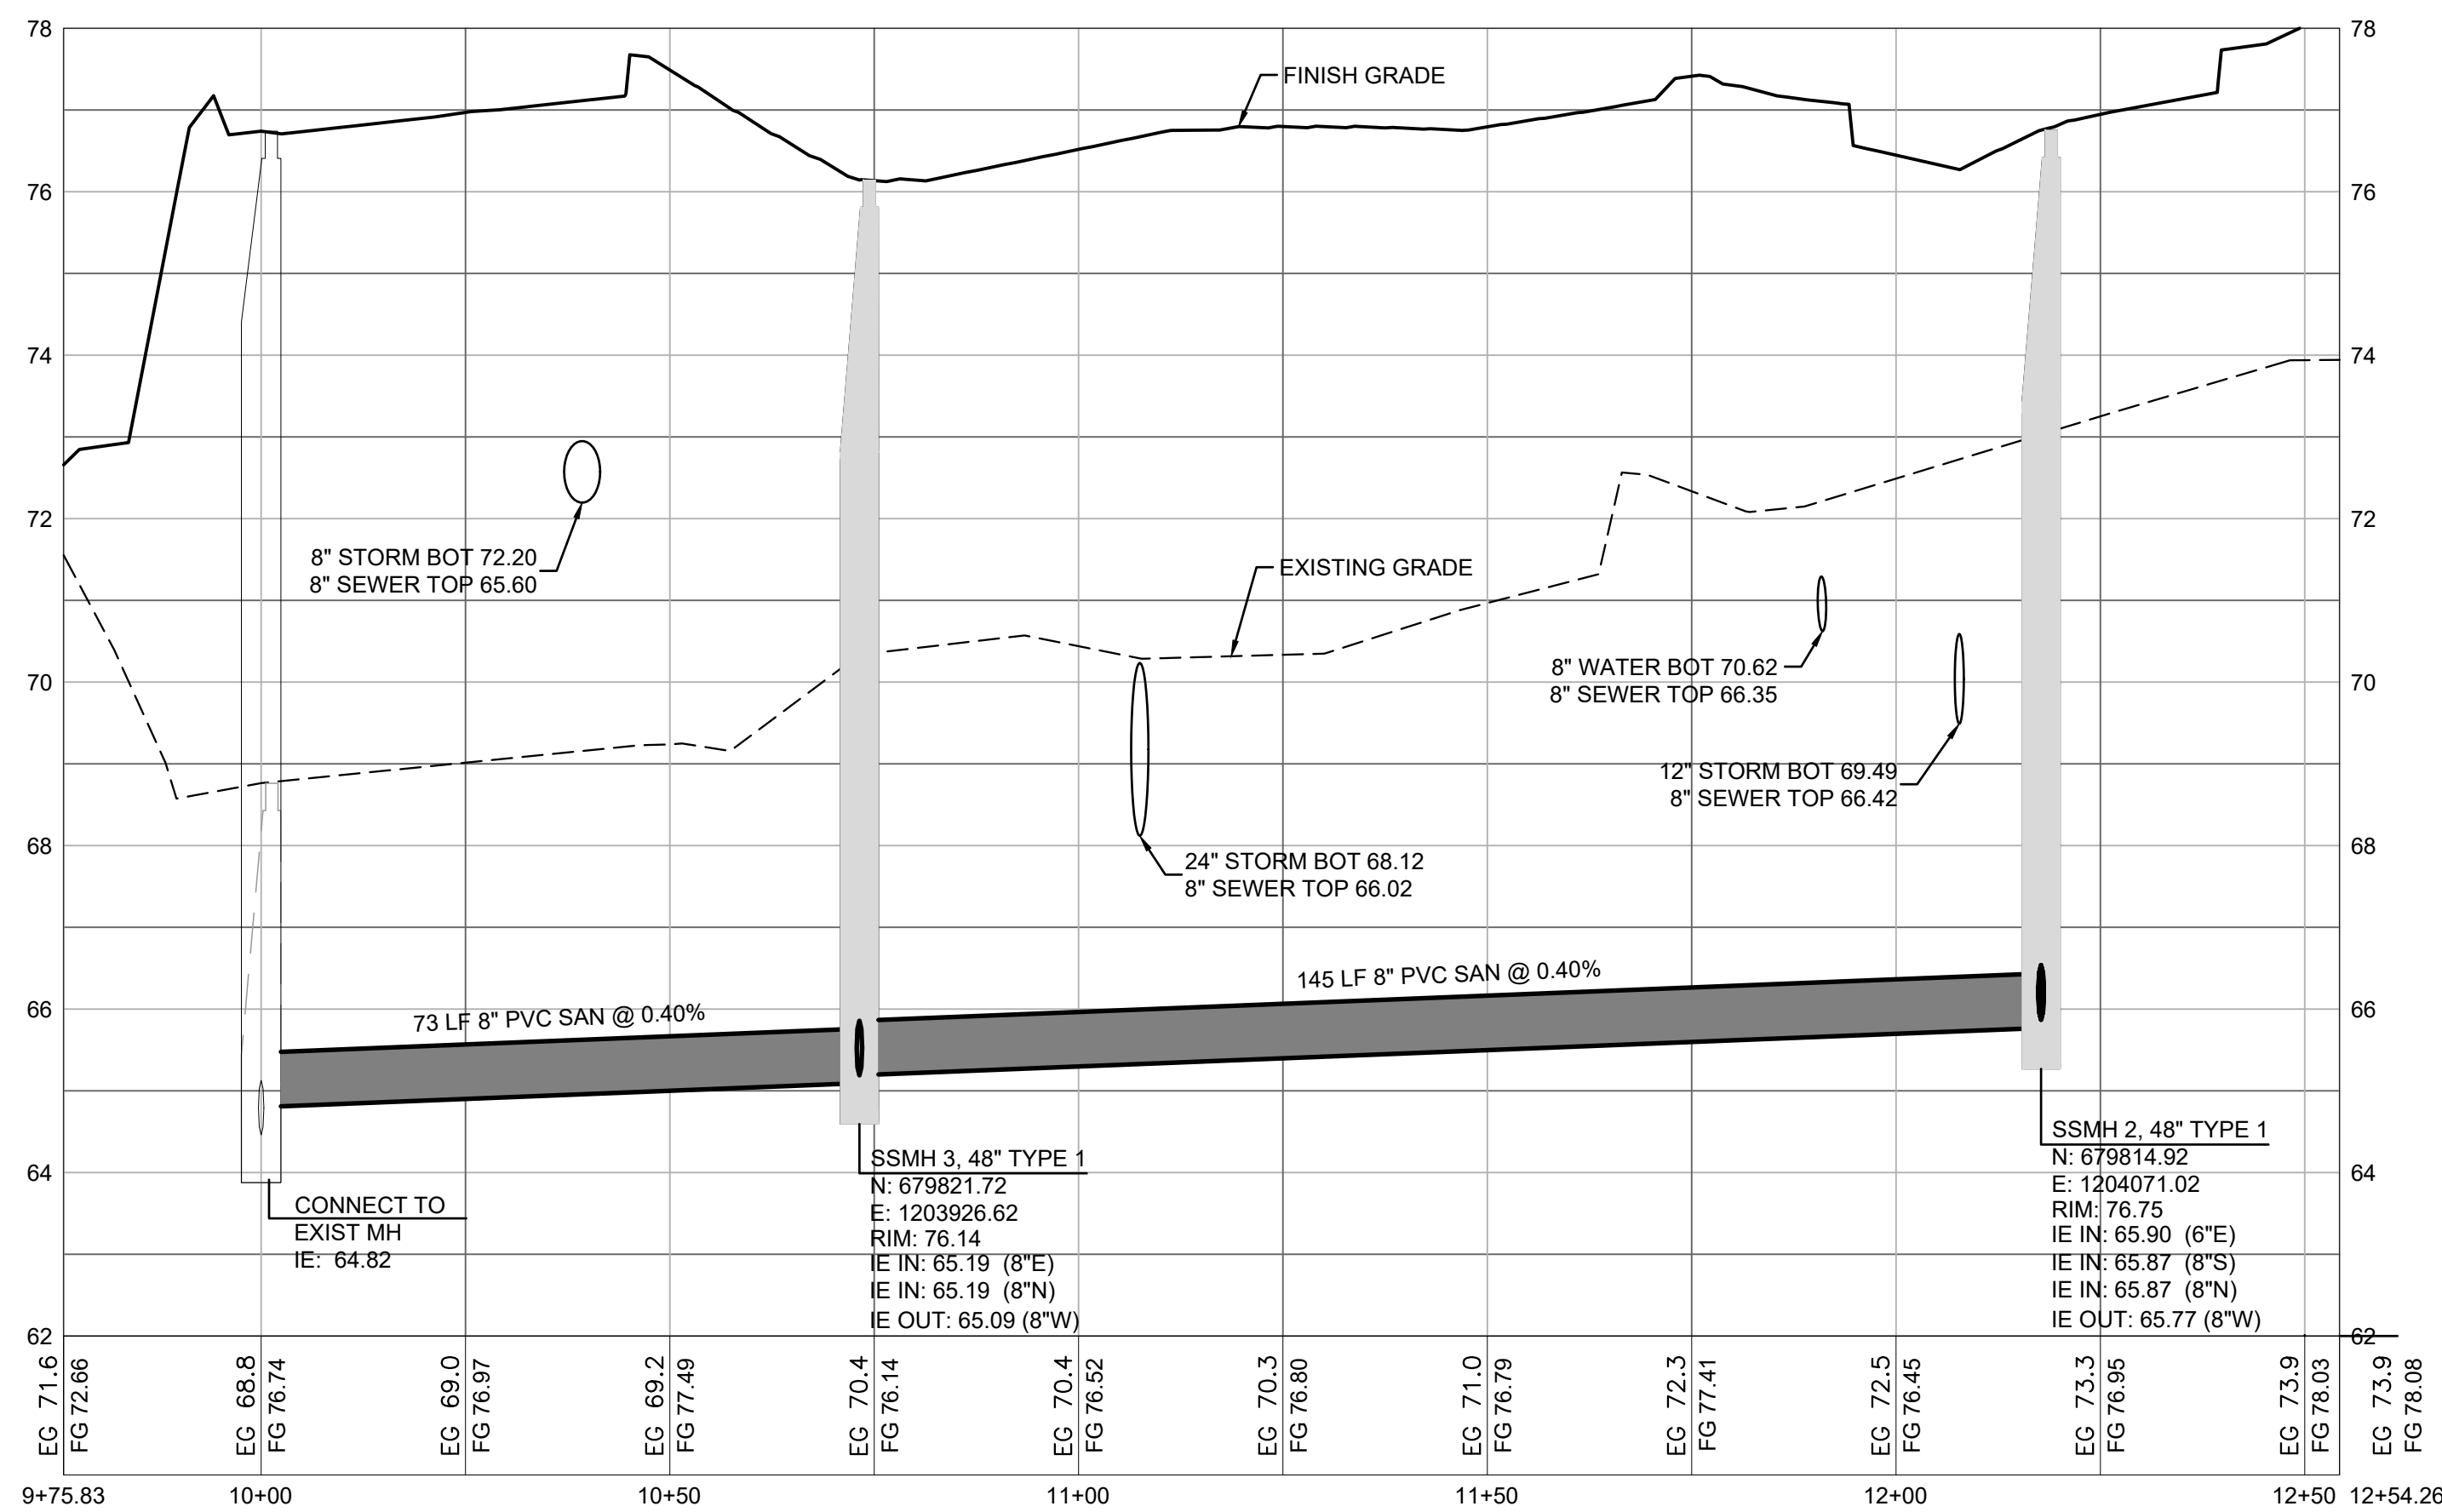

**1 SEWER PROFILE**  
 SCALE: HORIZ 1"=20'; VERT 1"=2'

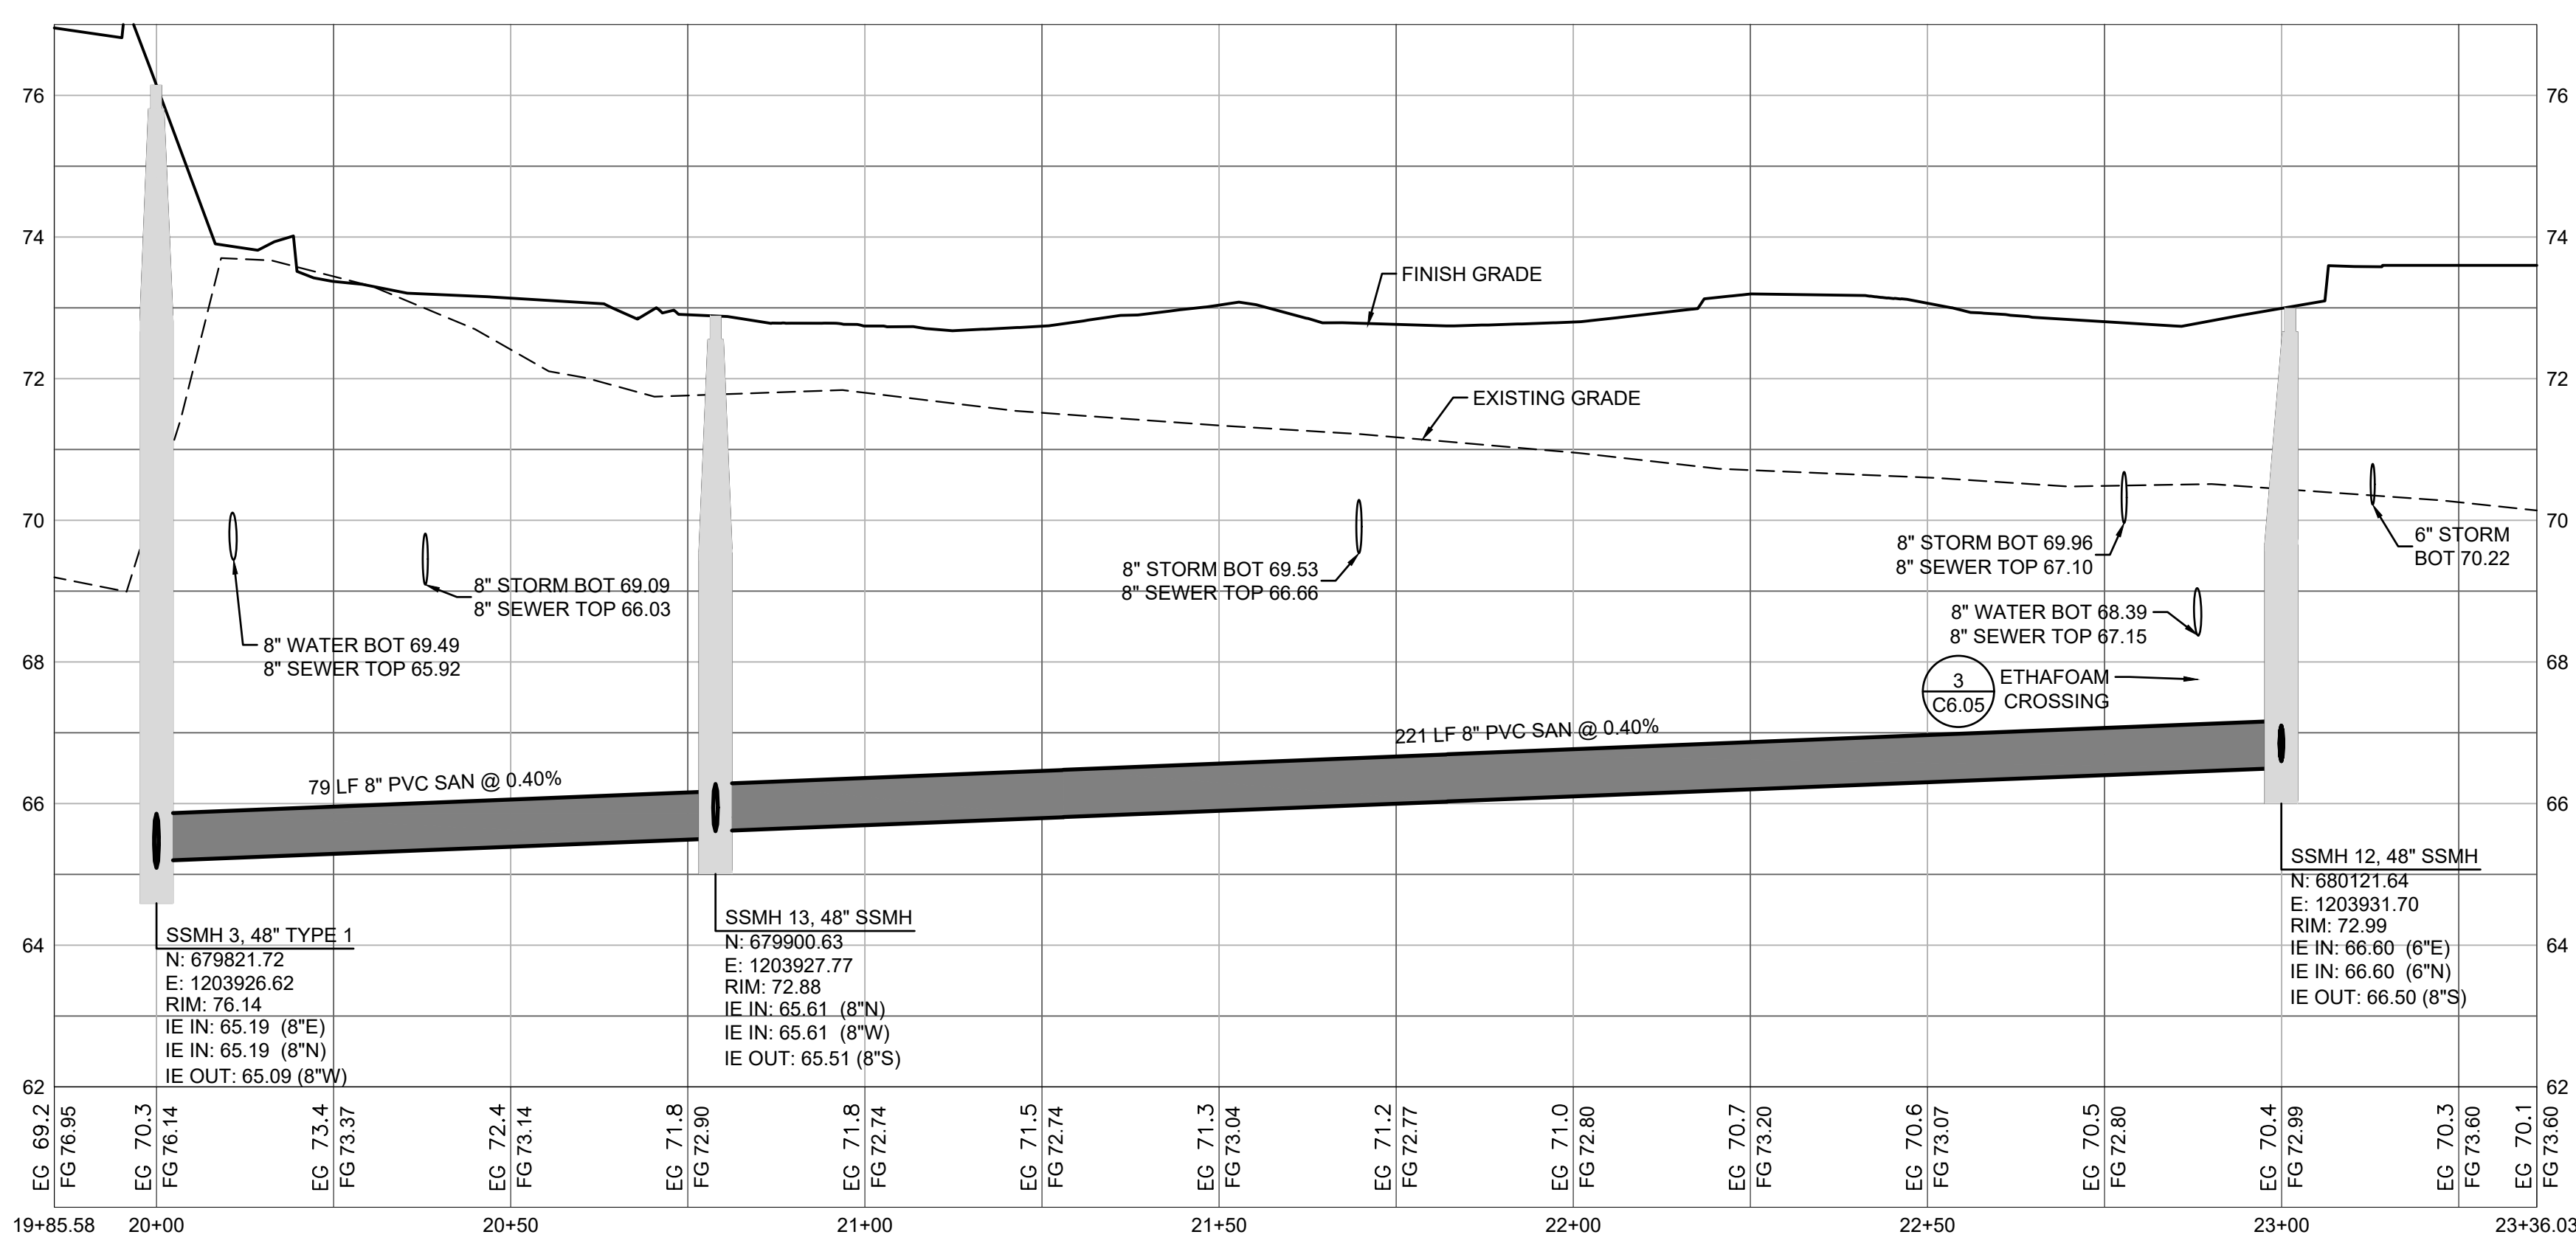

**2 SEWER PROFILE**  
 SCALE: HORIZ 1"=20'; VERT 1"=2'

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT REPRESENT A GUARANTEE OR WARRANTY BY THE ENGINEER OR ARCHITECT. THE ENGINEER OR ARCHITECT IS NOT TO BE USED FOR ANY OTHER PROJECT OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title:  
**SEWER PROFILES**

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C5.05**  
 38 of 53 Sheets






# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

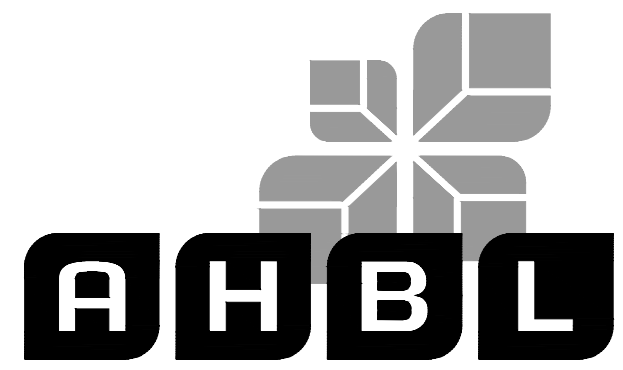

TACOMA · SEATTLE · SPOKANE · TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752


Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024




NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OR WARRANTY BY THE ENGINEER OR ARCHITECT FOR THE PROJECT DESCRIBED IN THE TITLE BLOCK AND NO PART OF IT IS TO BE USED FOR ANY OTHER PROJECT OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

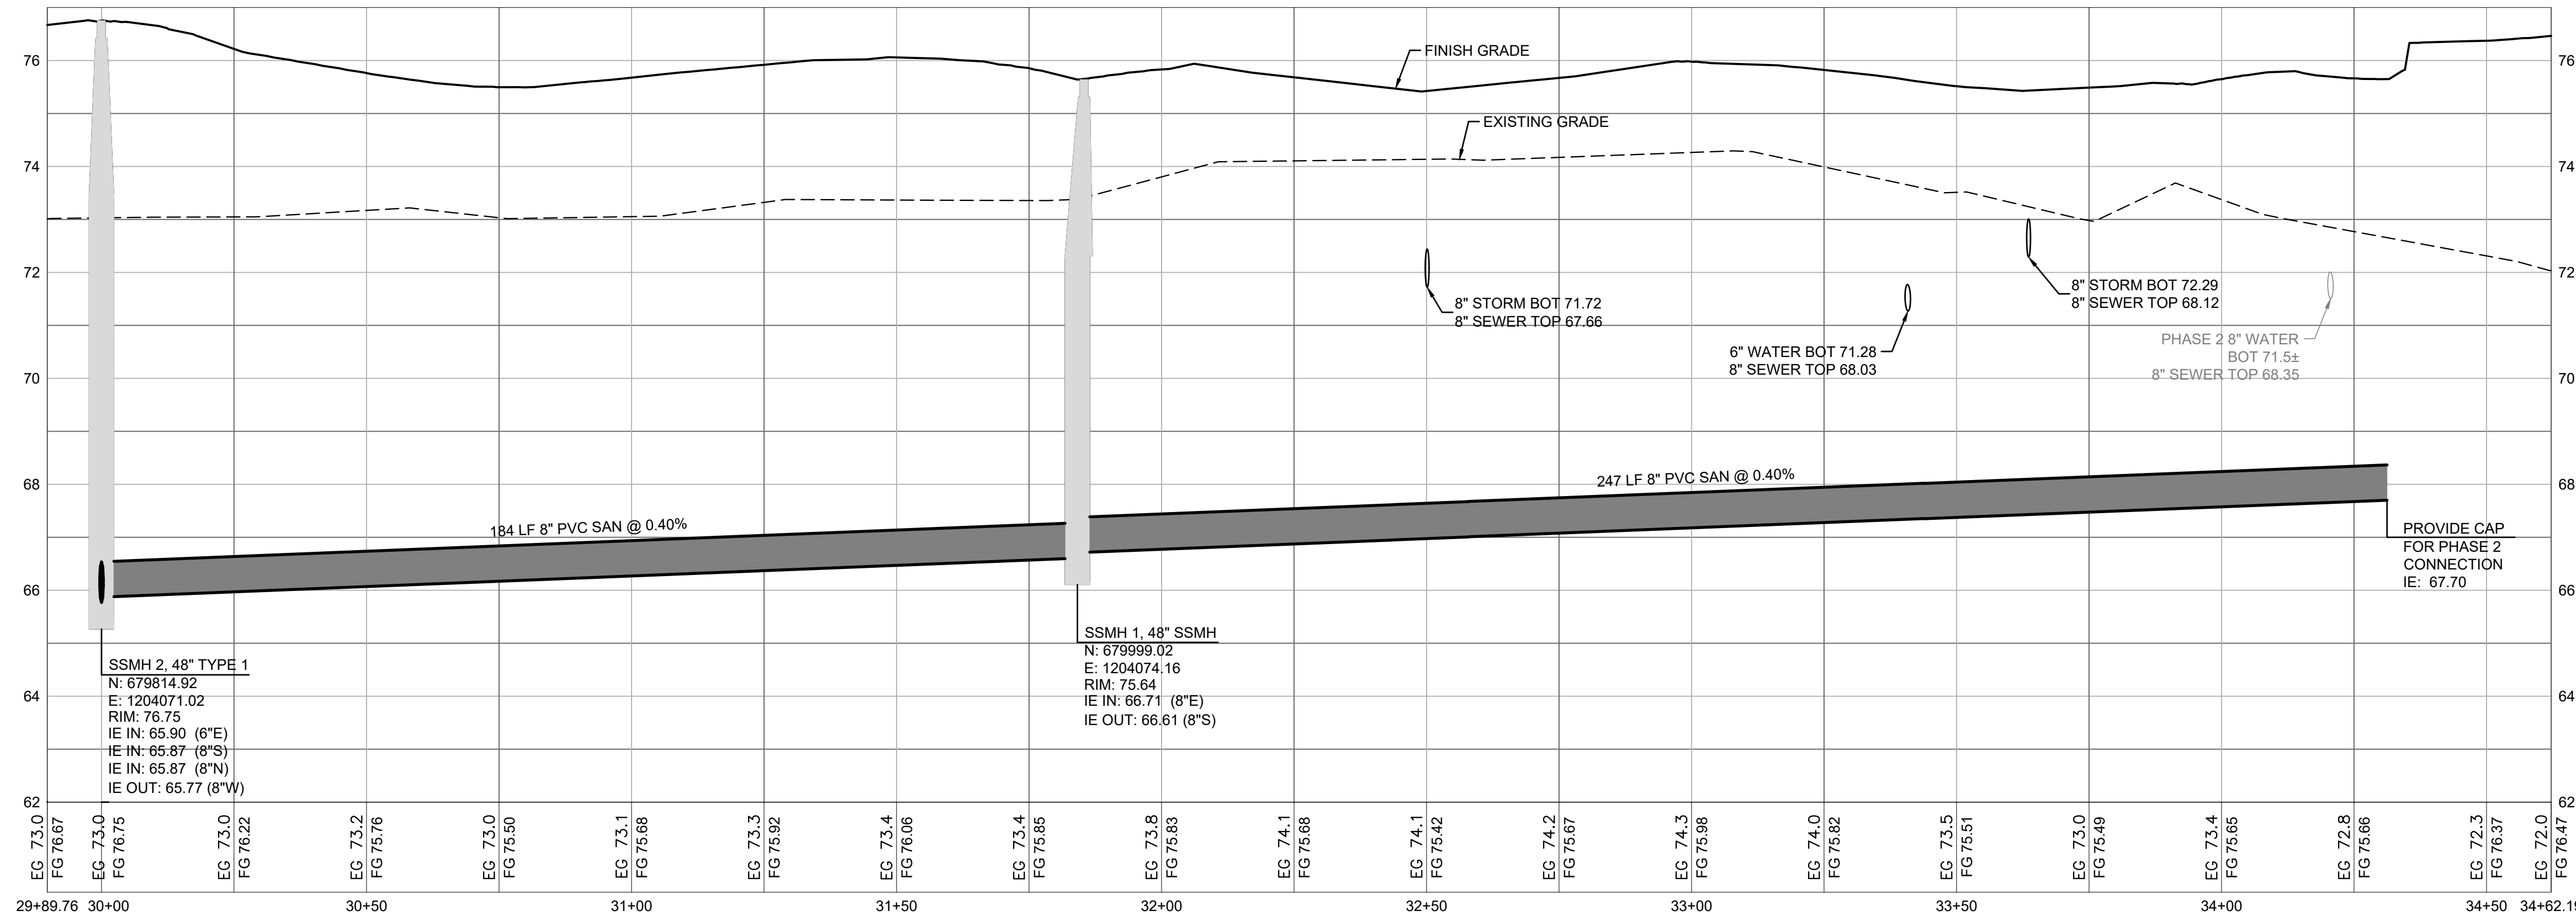

**3 SEWER PROFILE**  
 SCALE: HORIZ 1"=20'; VERT 1"=2'

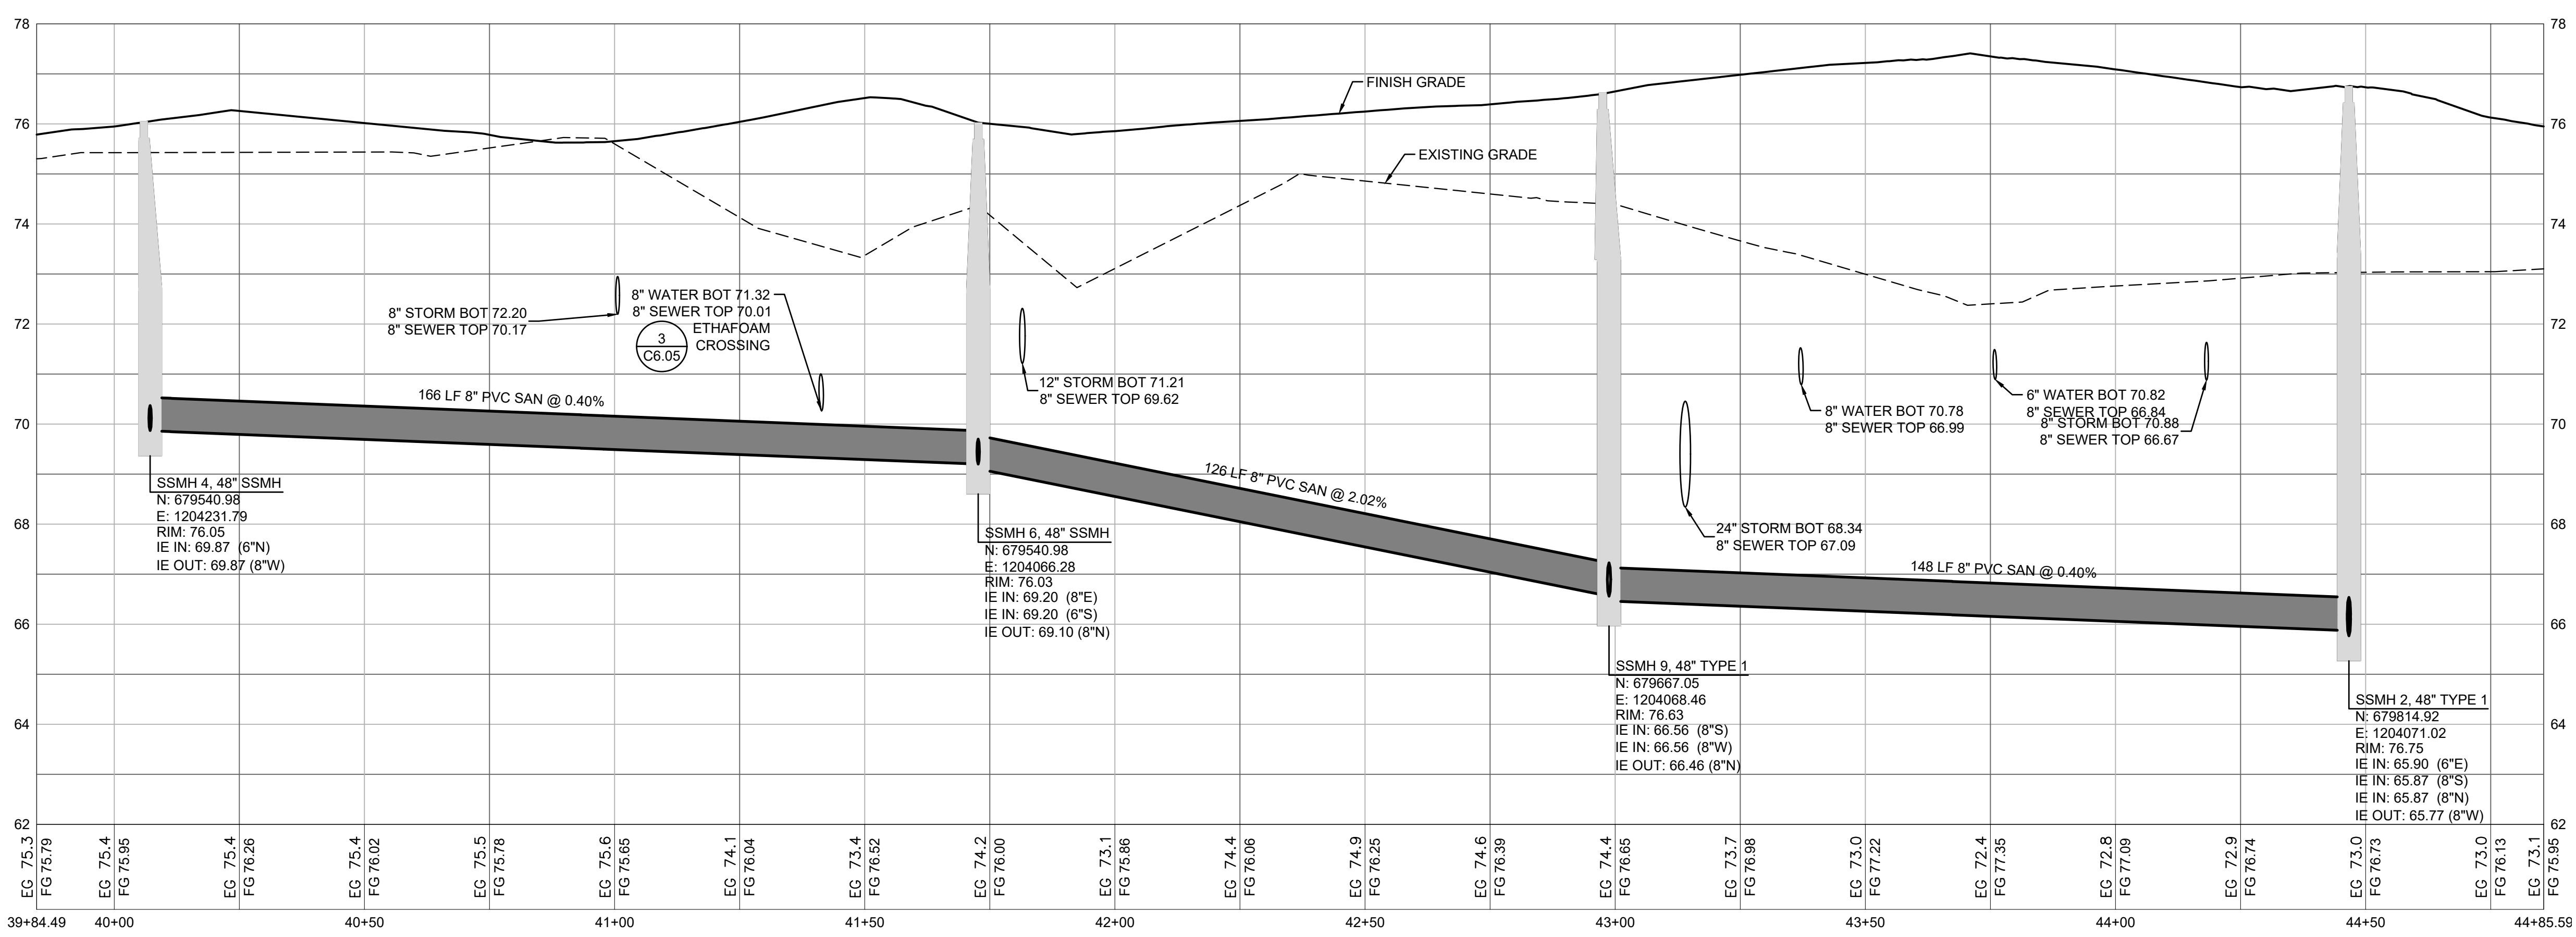

**4 SEWER PROFILE**  
 SCALE: HORIZ 1"=20'; VERT 1"=2'



Know what's below.  
 Call before you dig.

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title:

### SEWER PROFILES

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.

## C5.06



# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.



Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752


Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OR WARRANTY. THE ENGINEER OR ARCHITECT ASSUMES NO LIABILITY FOR THE PROJECT EXCEPT IN THE TITLE BLOCK AND IS NOT TO BE USED FOR OTHER PROJECTS OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

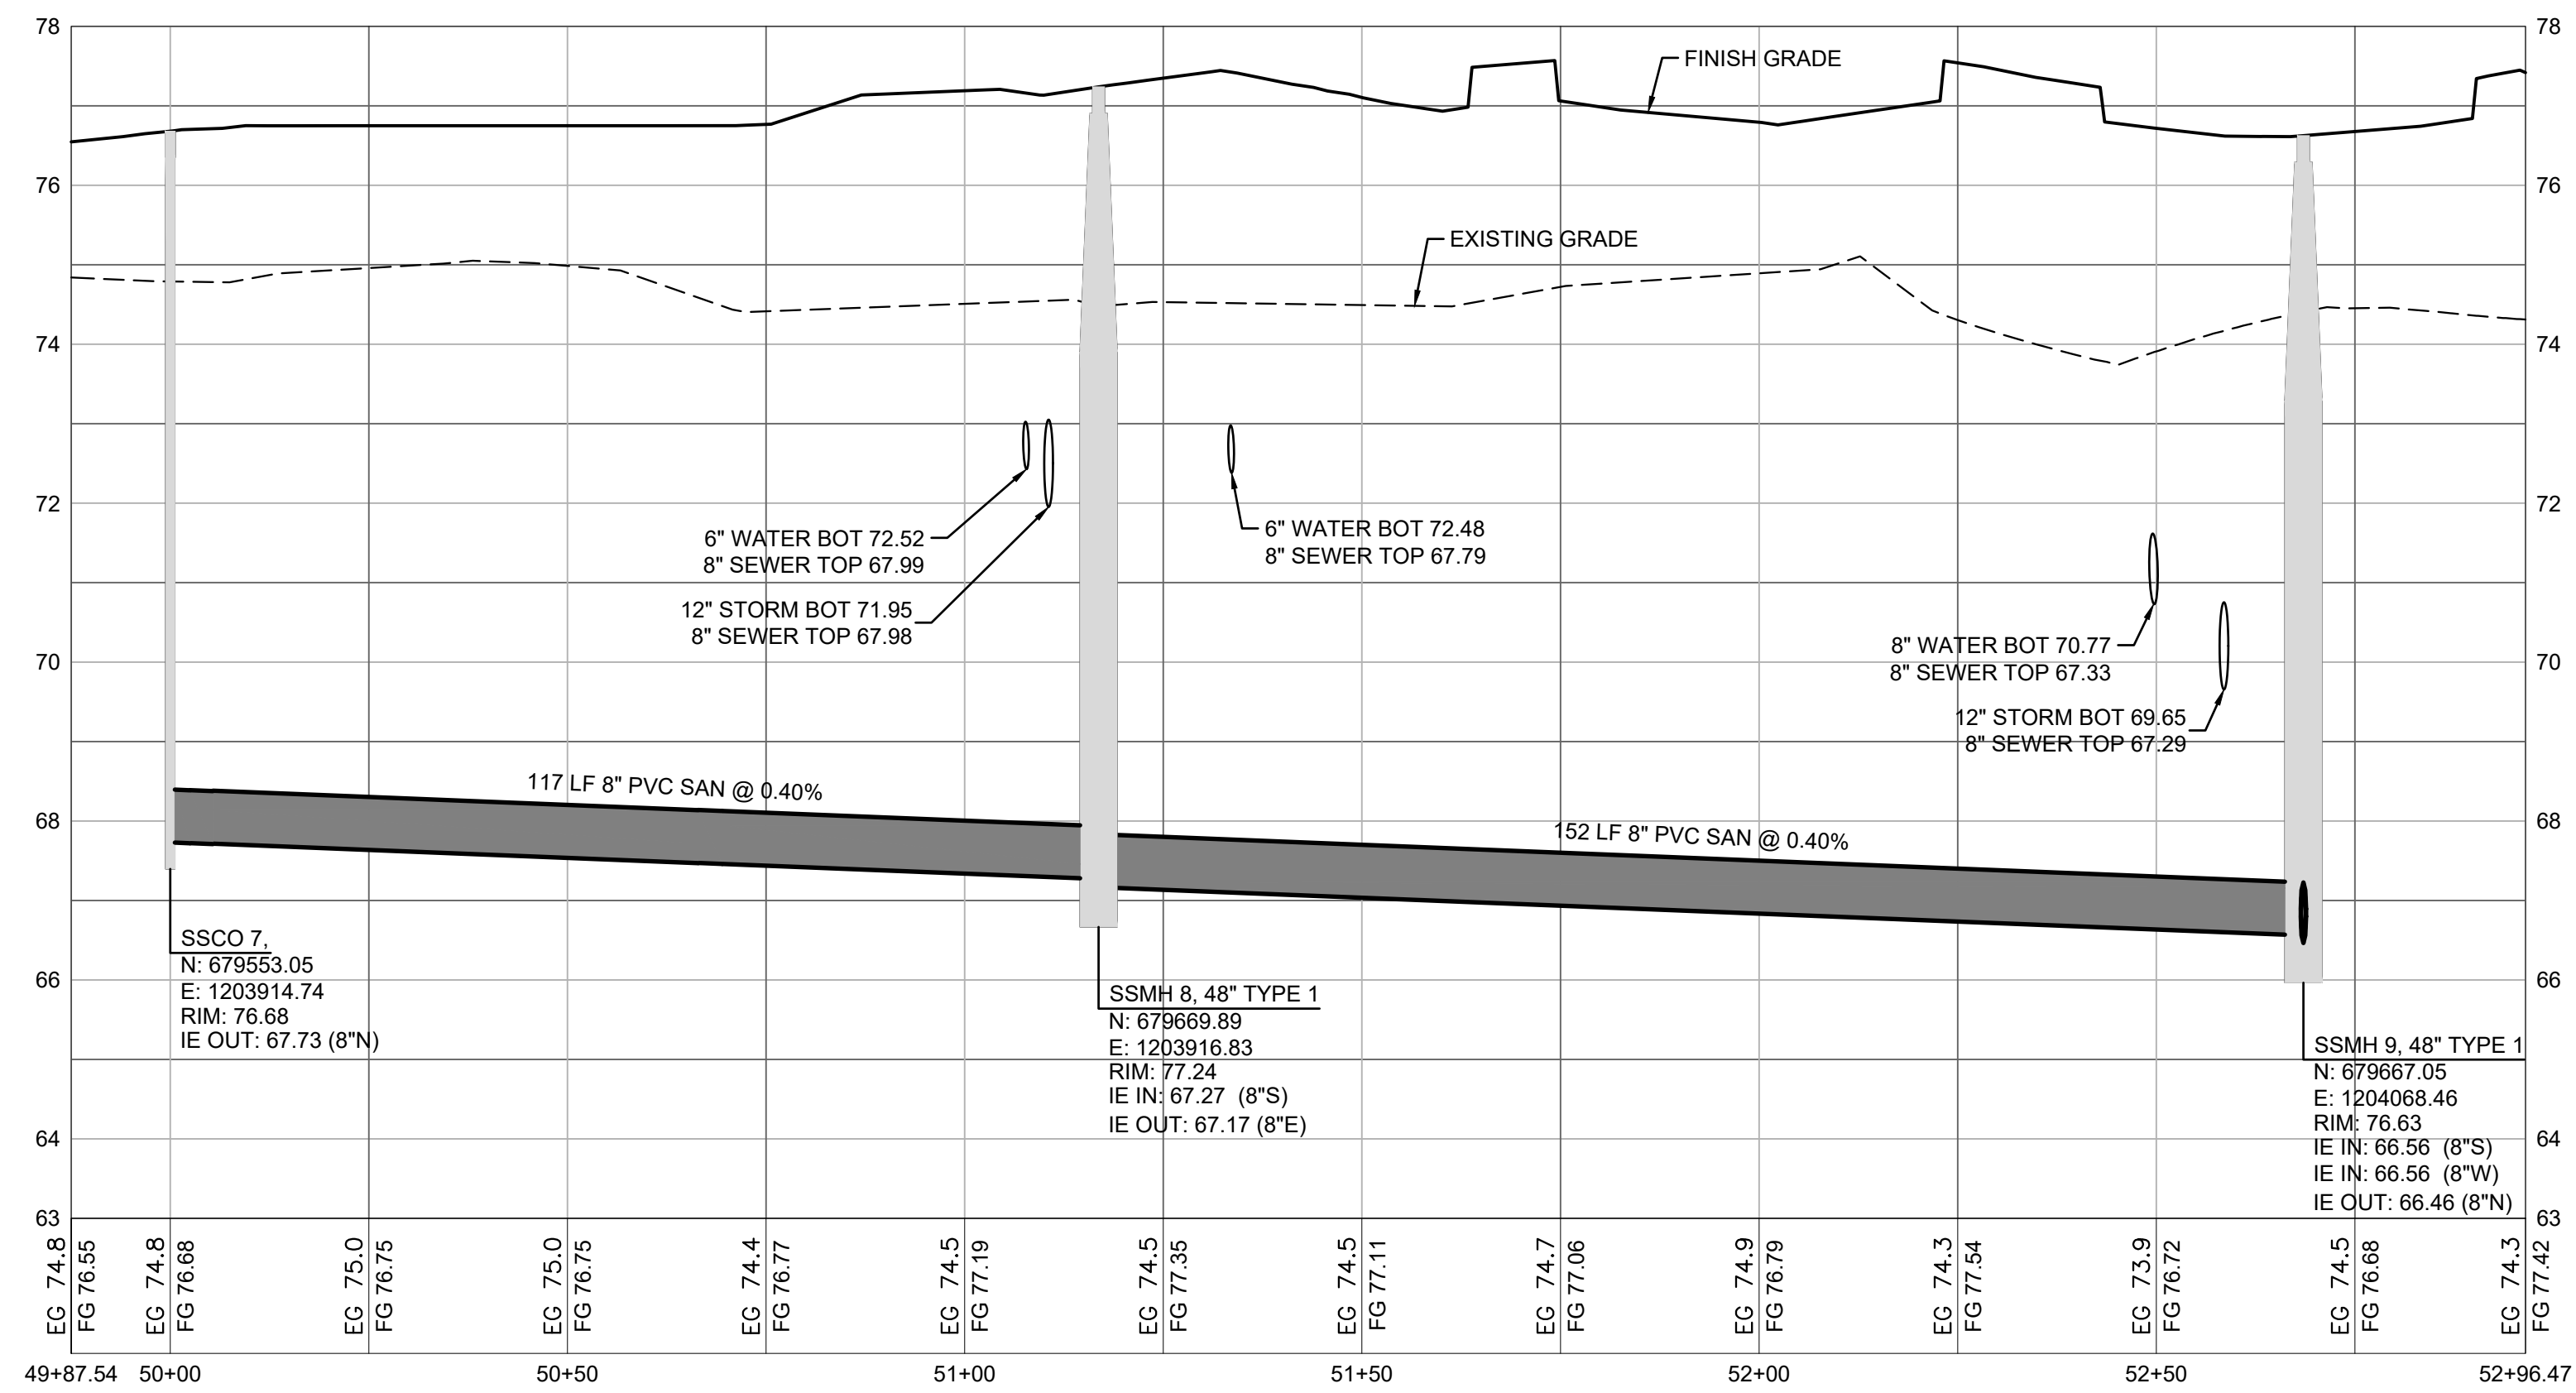

**5 SEWER PROFILE**  
 SCALE: HORIZ 1"=20'; VERT 1"=2'



03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title:  
**SEWER PROFILES**

Designed by: CW    Drawn by: SK / RS    Checked by: JI

Sheet No.  
**C5.07**  
 40 of 53 Sheets








# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

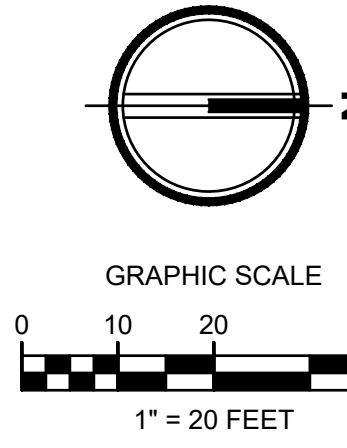


FIRE HYDRANT/FDC LOCATION/ACCESS APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 FIRE CODE OFFICIAL  
 DATE: 06/04/2024


NOTE:  
 THIS APPROVAL IS VOID AFTER 1 YEAR FROM APPROVAL DATE.  
 THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.  
 FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE:  
 THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.  
 THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.  
 FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

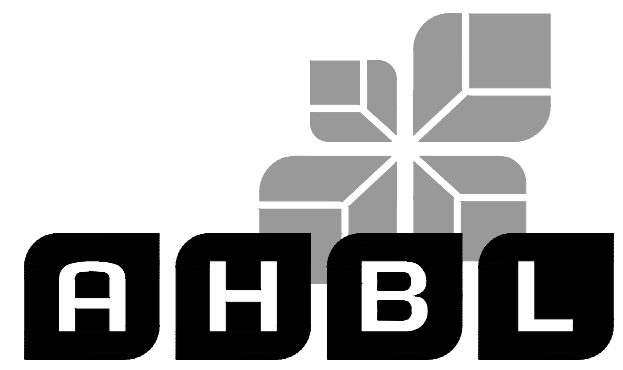

TACOMA • SEATTLE • SPOKANE • TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

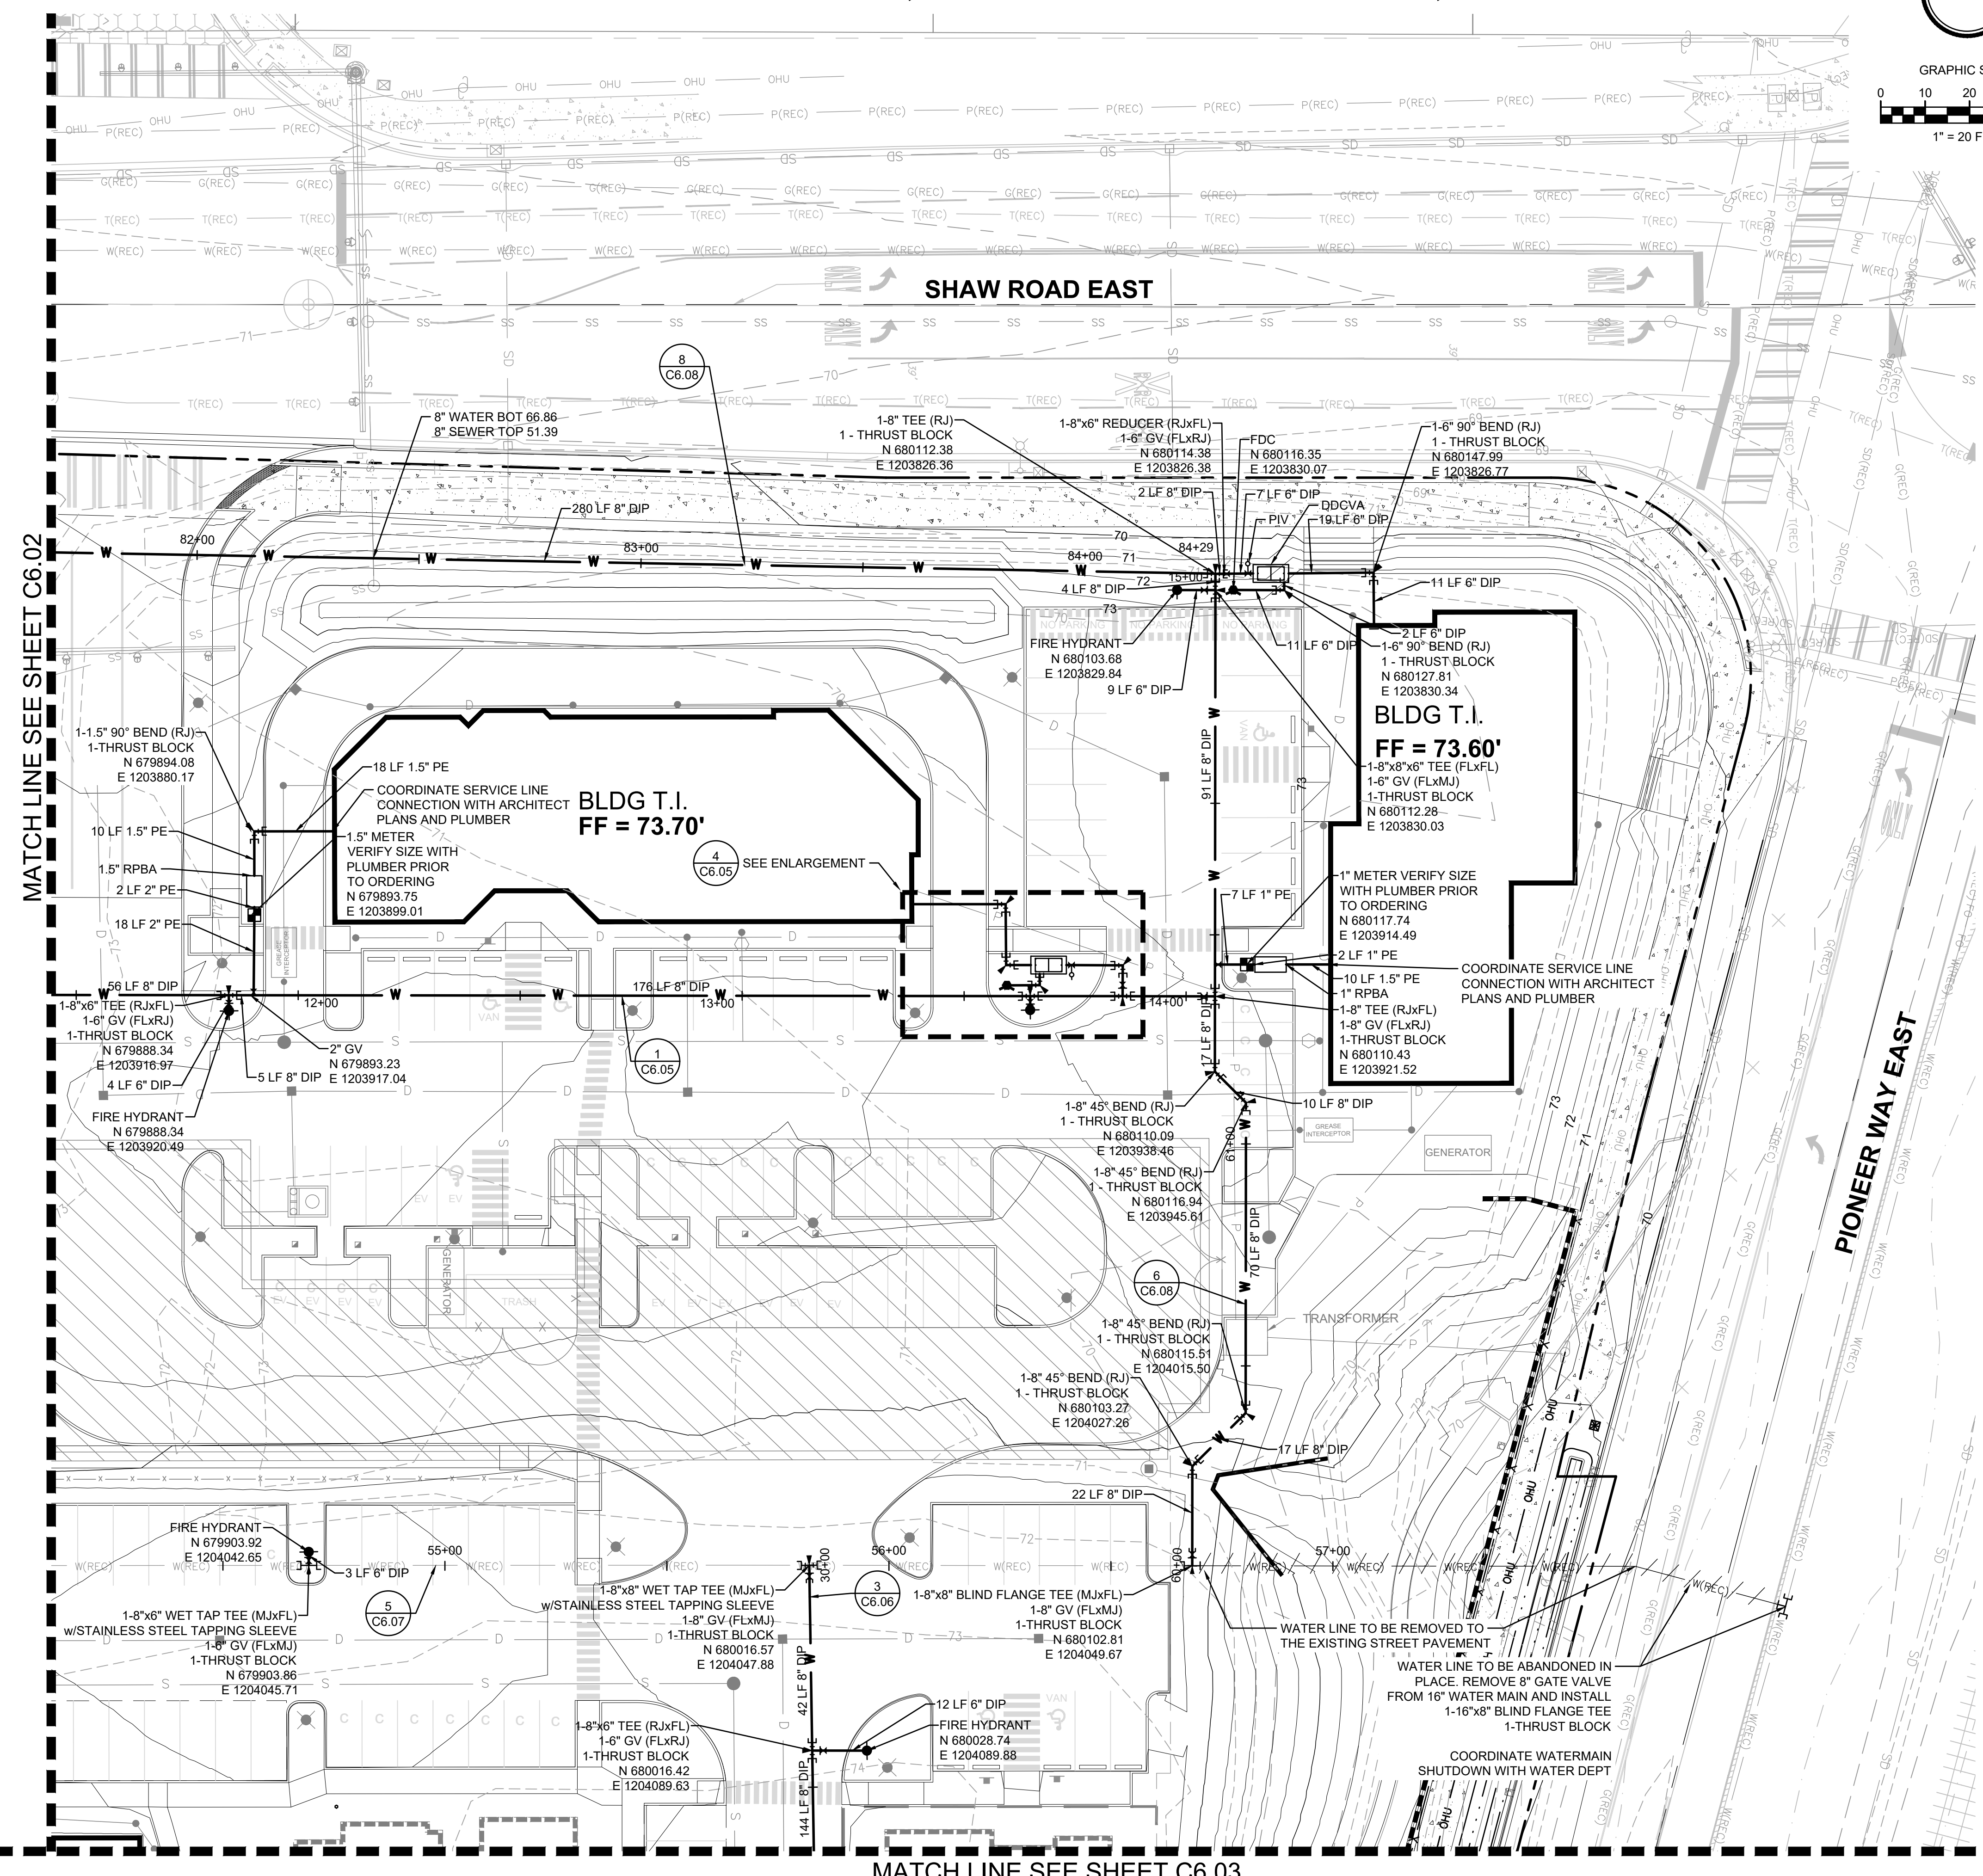

- ### GENERAL NOTES
- WET TAPS TO EXISTING WATER MAINS SHALL BE ACCOMPLISHED THROUGH A TAPPING TEE AND TAPPING VALVE, AND SHALL BE MADE BY A CITY APPROVED CONTRACTOR. THE TAPPING SLEEVE SHALL BE ROMAC SST ALL STAINLESS STEEL TAPPING SLEEVE OR APPROVED EQUAL. A TWO-PIECE EPOXY COATED OR DUCTILE IRON TAPPING SLEEVE MAY BE USED ON DUCTILE IRON PIPE, WHEN THE TAP IS SMALLER THAN THE WATER MAIN, I.E. 6" TAP ON 8" PIPE. THE CITY SHALL APPROVE THE TIME AND LOCATION FOR THESE CONNECTIONS.
  - IF THE PROJECT IS UTILIZING A FIRE BOOSTER PUMP, THE FDC MUST CONNECT TO THE SPRINKLER SYSTEM ON THE DISCHARGE SIDE OF THE PUMP IN ACCORDANCE WITH NFPA REGULATIONS.


- ### DETAIL REFERENCES
- HORIZONTAL THRUST BLOCKING 1 C6.09
  - VERTICAL THRUST BLOCKING 2 C6.09
  - THRUST BLOCKING TABLE 3 C6.09
  - 3/4" OR 1" WATER SERVICE CONNECTION 4 C6.09
  - 1-1/2" OR 2" WATER SERVICE CONNECTION 5 C6.09
  - PRIVATE WATER SERVICE LINES 6 C6.09
  - 2" AND SMALLER DCVA INSTALLATION 7 C6.09
  - FIRE HYDRANT ASSEMBLY 8 C6.09
  - 2" BLOW-OFF ASSEMBLY 1 C6.10
  - DCVA ASSEMBLY AND NOTES 2 C6.10 3 C6.10
  - FIRE DEPARTMENT CONNECTION 4 C6.10
  - POST INDICATOR VALVE 5 C6.10
  - WATER VALVES AND MAINS 1 C6.11
  - WATER MAIN CROSSING OTHER UTILITIES AND NOTES 2 C6.11 3 C6.11
  - 2" AND SMALLER RPBA ASSEMBLY INSTALLATION 4 C6.11
  - WATER VAULT DETAILS 5 C6.11

### FIRE PROTECTION NOTES

THE FIRE PROTECTION SYSTEM INCLUDING MATERIALS, SIZING, AND CONFIGURATION IS SUBJECT TO A CONTRACTOR PROVIDED DESIGN BY A FIRE PROTECTION ENGINEER, AND AS SUCH, THE FINAL DESIGN OF THE FIRE PROTECTION SYSTEM MAY DEVIATE FROM THE SYSTEM SHOWN. THE FIRE PROTECTION SYSTEM AS SHOWN FROM THE MAIN LINE TO THE CONNECTION AT THE BUILDING SPRINKLER IS INTENDED FOR LOCATION OF THE FIRE HYDRANTS AND FIRE DEPARTMENT CONNECTION ONLY. CONTRACTOR'S BID SHALL REFLECT THE CONDITIONS OF THE FIRE PROTECTION ENGINEER'S DESIGN. CONTRACTOR SHALL COMPLY WITH ALL NATIONAL FIRE PROTECTION ASSOCIATION REQUIREMENTS AS SET FORTH BY "NFPA 13", ITS AMENDMENTS, AND LOCAL REQUIREMENTS, INCLUDING BUT NOT LIMITED TO ACQUISITION OF ALL PERMITS.

### FIRE SPRINKLER NOTE

WHERE THE UNDERGROUND WATER SUPPLY TEES OFF TO SERVE ONLY A FIRE SPRINKLER SYSTEM AND/OR FIRE HYDRANTS, A SEPARATE DETAILED PLAN MUST BE SUBMITTED AND APPROVED BY THE FIRE MARSHAL PRIOR TO INSTALLATION.

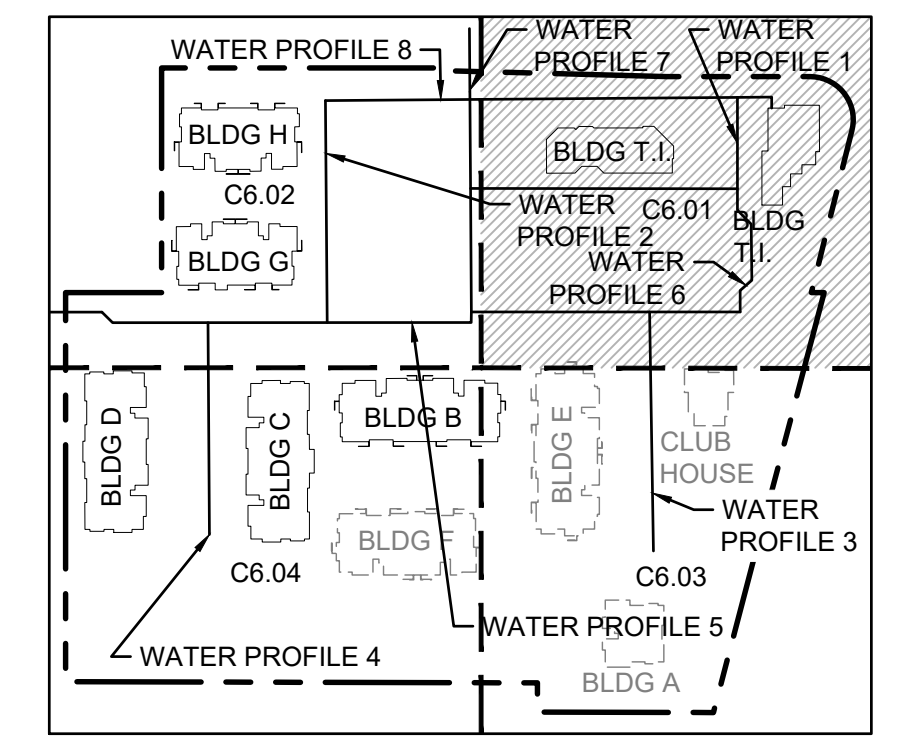


Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
**ASH DEVELOPMENT**  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 04/09/2024

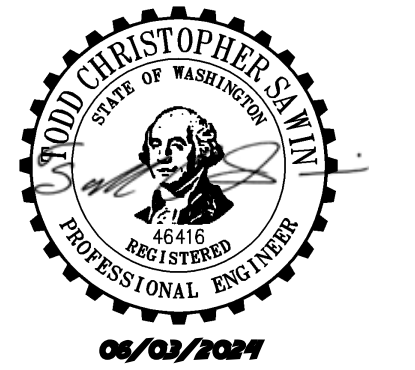

NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A PROFESSIONAL ENGINEER'S ENDORSEMENT OF THE PROJECT OR THE QUALITY OF THE WORK. THIS DOCUMENT IS NOT TO BE USED FOR ANY OTHER PROJECT, IN ADDITION TO THAT PROJECT FOR WHICH IT WAS PREPARED.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

- A
  - A
  - A 03/29/24 CITY COMMENTS
  - A 01/29/24 CITY COMMENTS
- Revisions:

Sheet Title:  
**WATER PLAN NW**

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI


Sheet No.  
**C6.01**  
 42 of 53 Sheets





# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

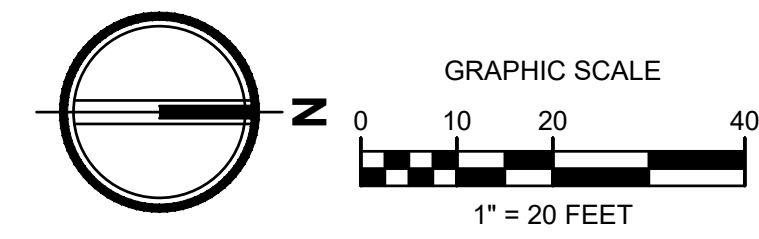


FIRE HYDRANT/FDC LOCATION/ACCESS APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 FIRE CODE OFFICIAL  
 DATE: 06/04/2024

NOTE:  
 THIS APPROVAL IS VOID AFTER 1 YEAR FROM APPROVAL DATE.  
 THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.  
 FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE FIRE CODE OFFICIAL.

APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE:  
 THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.  
 THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.  
 FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

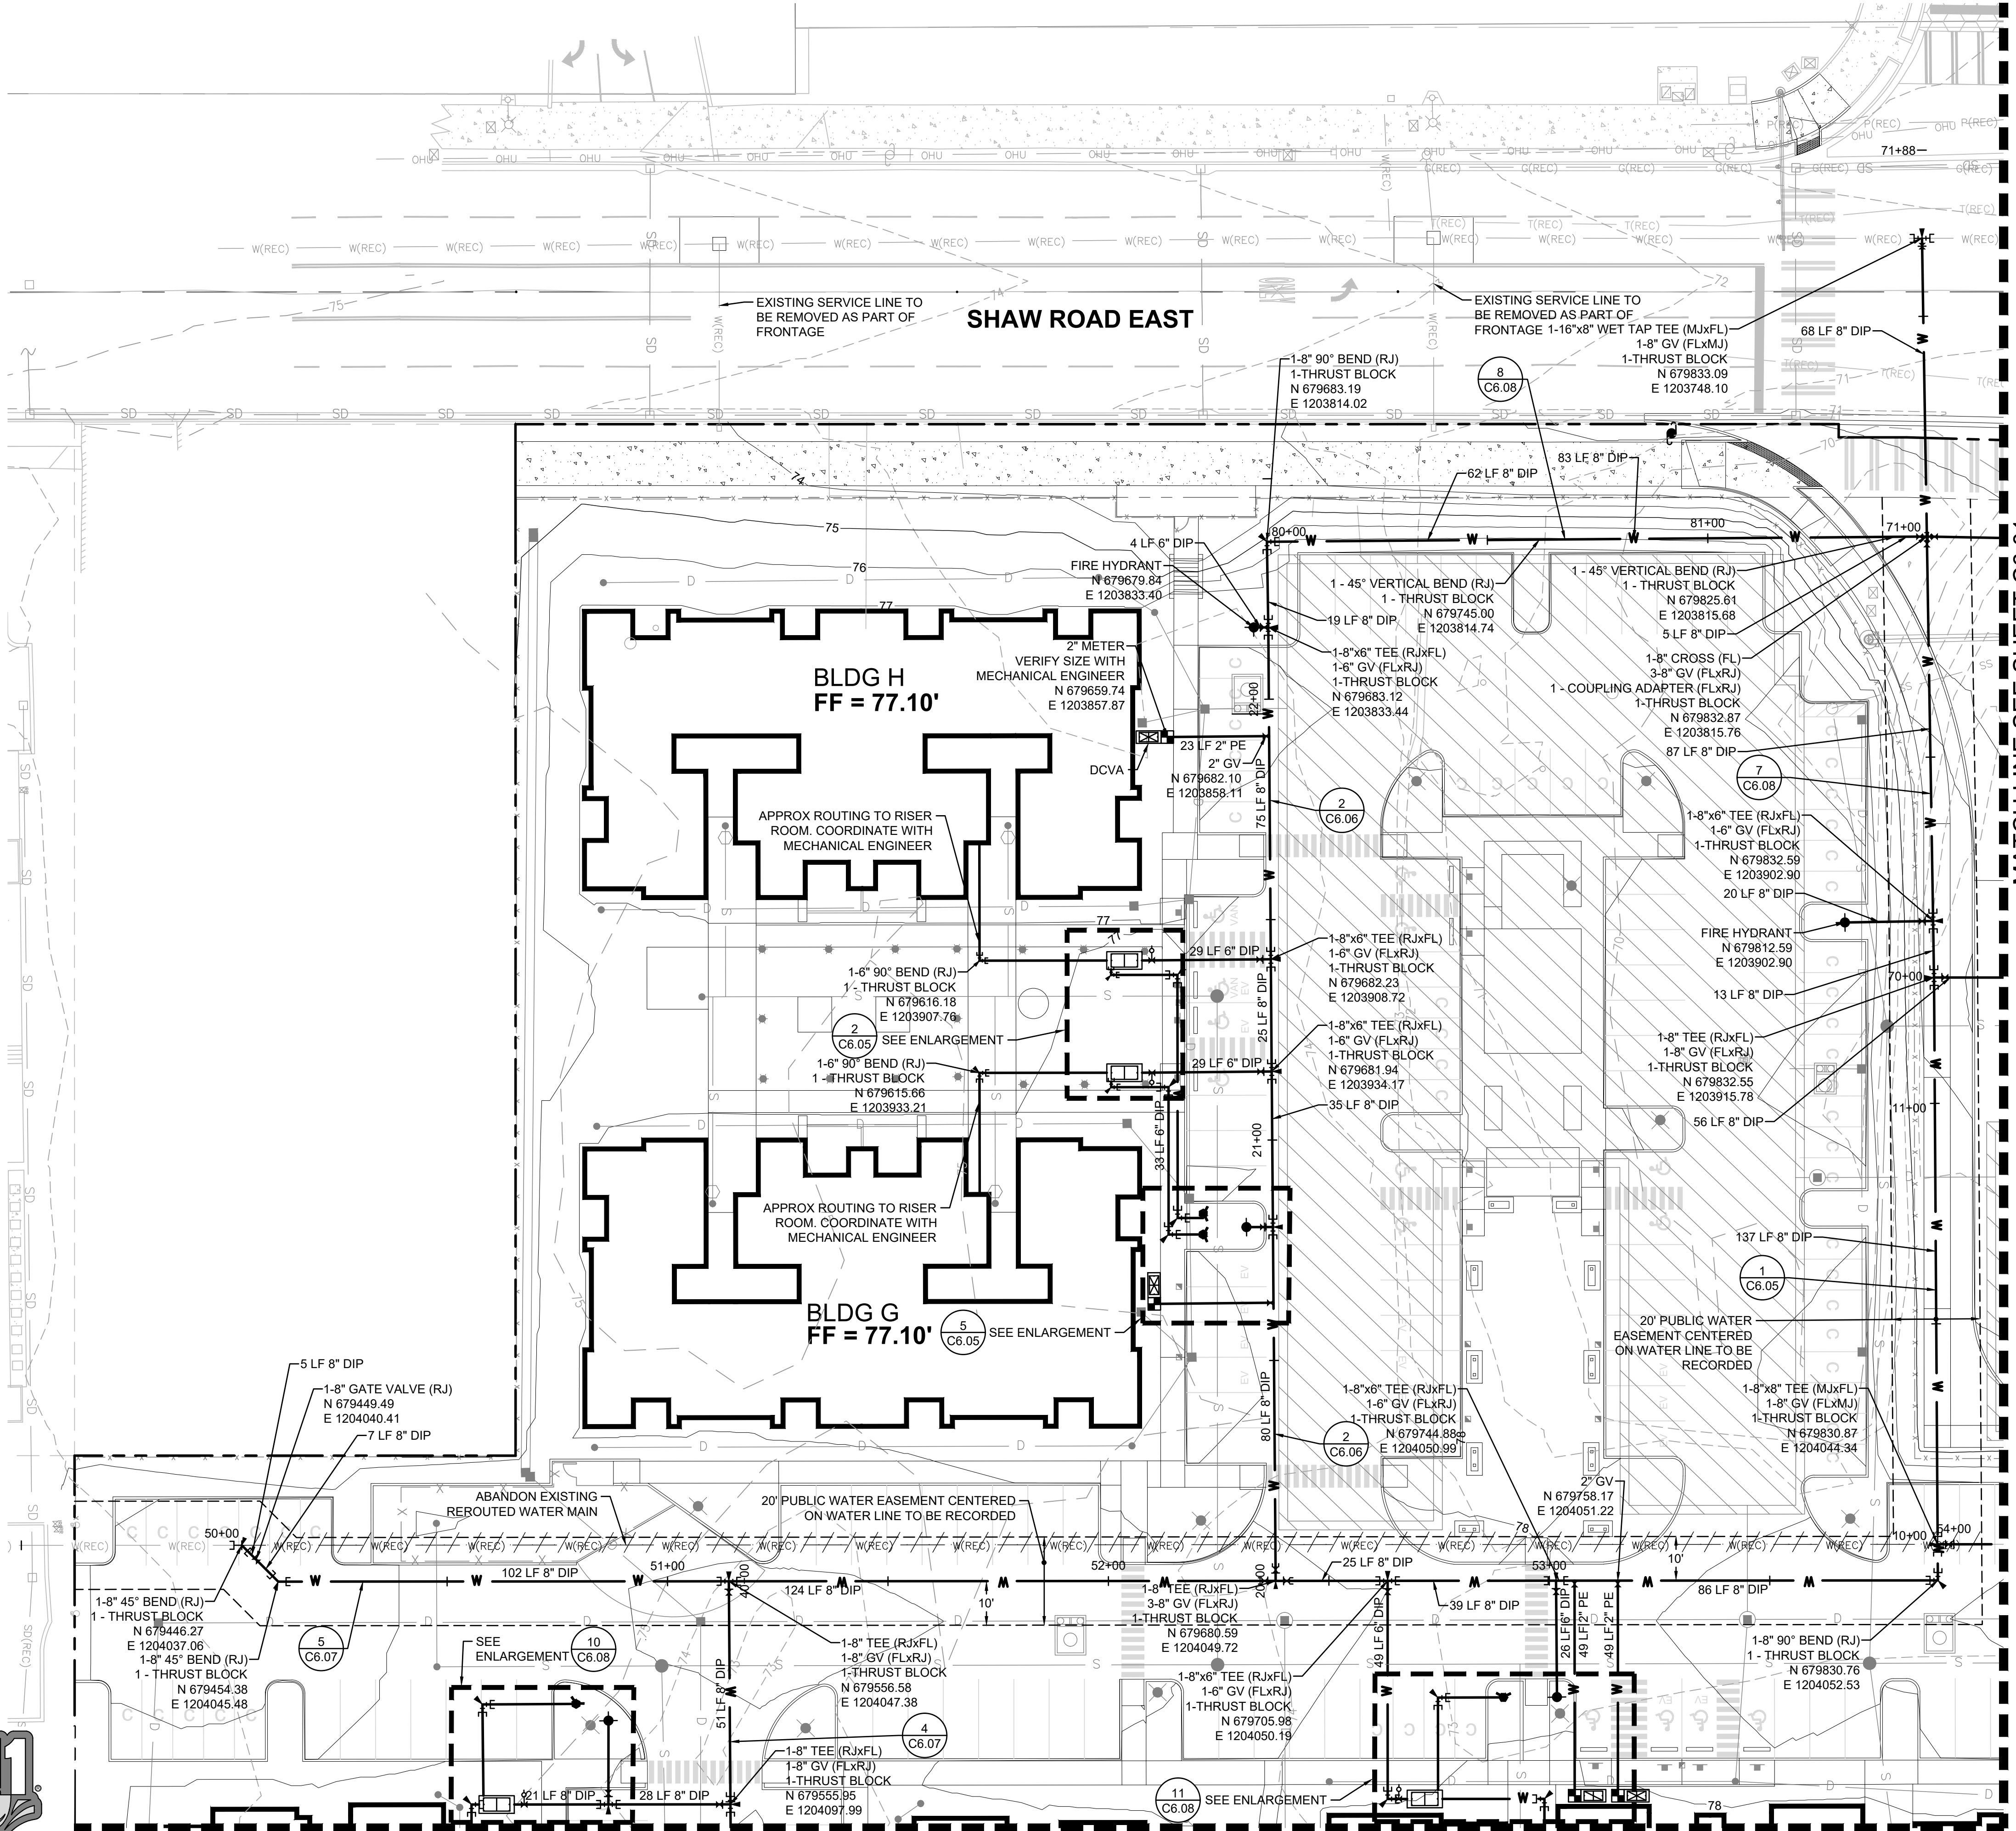


### GENERAL NOTES

- WET TAPS TO EXISTING WATER MAINS SHALL BE ACCOMPLISHED THROUGH A TAPPING TEE AND TAPPING VALVE, AND SHALL BE MADE BY A CITY APPROVED CONTRACTOR. THE TAPPING SLEEVE SHALL BE ROMAC SST ALL STAINLESS STEEL TAPPING SLEEVE OR APPROVED EQUAL. A TWO-PIECE EPOXY COATED OR DUCTILE IRON TAPPING SLEEVE MAY BE USED ON DUCTILE IRON PIPE, WHEN THE TAP IS SMALLER THAN THE WATER MAIN, I.E. 6" TAP ON 8" PIPE. THE CITY SHALL APPROVE THE TIME AND LOCATION FOR THESE CONNECTIONS.
- IF THE PROJECT IS UTILIZING A FIRE BOOSTER PUMP, THE FDC MUST CONNECT TO THE SPRINKLER SYSTEM ON THE DISCHARGE SIDE OF THE PUMP IN ACCORDANCE WITH NFPA REGULATIONS.

### DETAIL REFERENCES

- HORIZONTAL THRUST BLOCKING (1) C6.09
- VERTICAL THRUST BLOCKING (2) C6.09
- THRUST BLOCKING TABLE (3) C6.09
- 3/4" OR 1" WATER SERVICE CONNECTION (4) C6.09
- 1-1/2" OR 2" WATER SERVICE CONNECTION (5) C6.09
- PRIVATE WATER SERVICE LINES (6) C6.09
- 2" AND SMALLER DCVA INSTALLATION (7) C6.09
- FIRE HYDRANT ASSEMBLY (8) C6.09
- 2" BLOW-OFF ASSEMBLY (1) C6.10
- DCVA ASSEMBLY AND NOTES (2) C6.10 (3) C6.10
- FIRE DEPARTMENT CONNECTION (4) C6.10
- POST INDICATOR VALVE (5) C6.10
- WATER VALVES AND MAINS (1) C6.11
- WATER MAIN CROSSING OTHER UTILITIES AND NOTES (2) C6.11 (3) C6.11
- 2" AND SMALLER RPBA ASSEMBLY INSTALLATION (4) C6.11
- WATER VAULT DETAILS (5) C6.11

MATCH LINE SEE SHEET C6.01

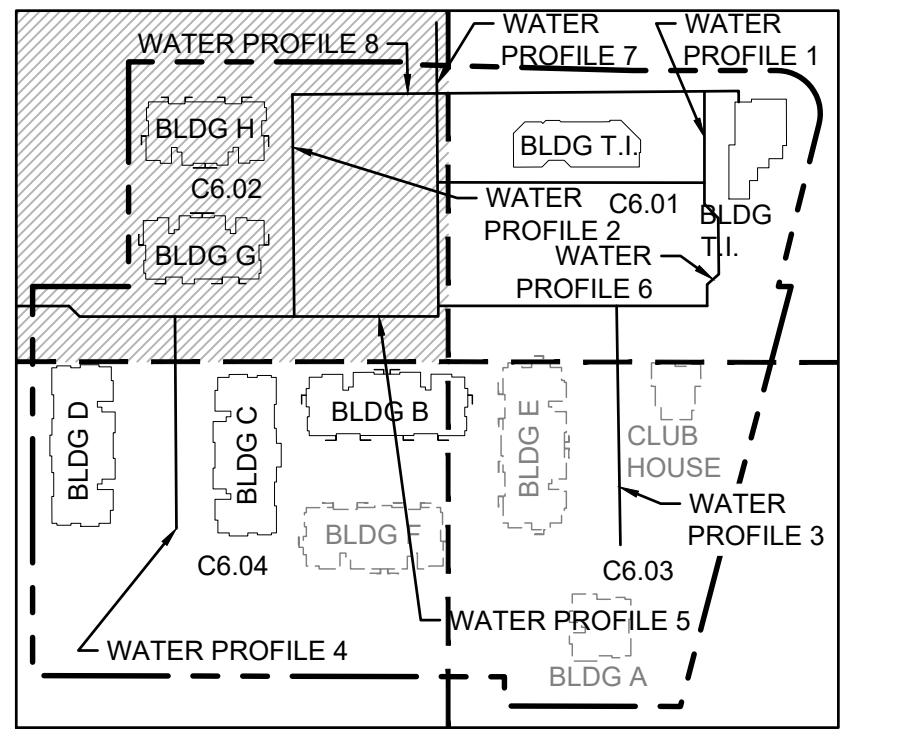


Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

Project No.  
 2230752

Issue Set & Date:  
 PERMIT SUBMITTAL

Issue Date:  
 04/09/2024

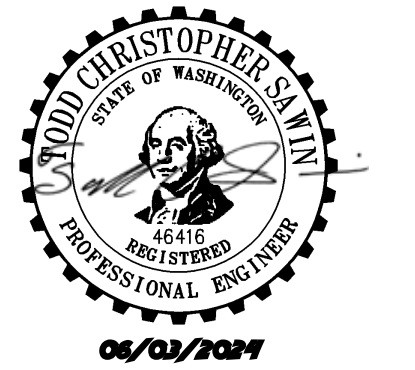

NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OR WARRANTY BY THE ENGINEER. THE ENGINEER IS NOT RESPONSIBLE FOR THE PROJECT EXCEPT IN THE FIELD WORK AND NOT TO BE USED FOR OTHER PURPOSES OR ADDITION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

- 03/29/24 CITY COMMENTS
- 01/29/24 CITY COMMENTS

Revisions:  
 Sheet Title:  
**WATER PLAN SW**

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI


Sheet No.  
**C6.02**  
 43 of 53 Sheets





# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

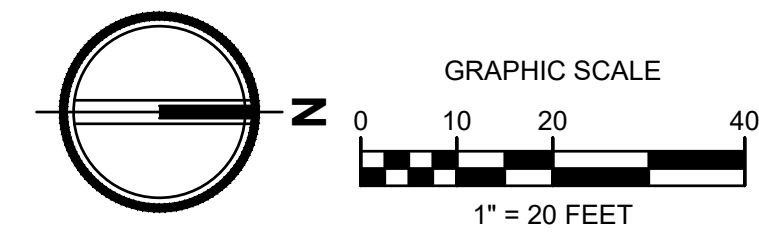


FIRE HYDRANT/FDC LOCATION/ACCESS APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 FIRE CODE OFFICIAL  
 DATE: 06/04/2024

APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024



MATCH LINE SEE SHEET C6.01

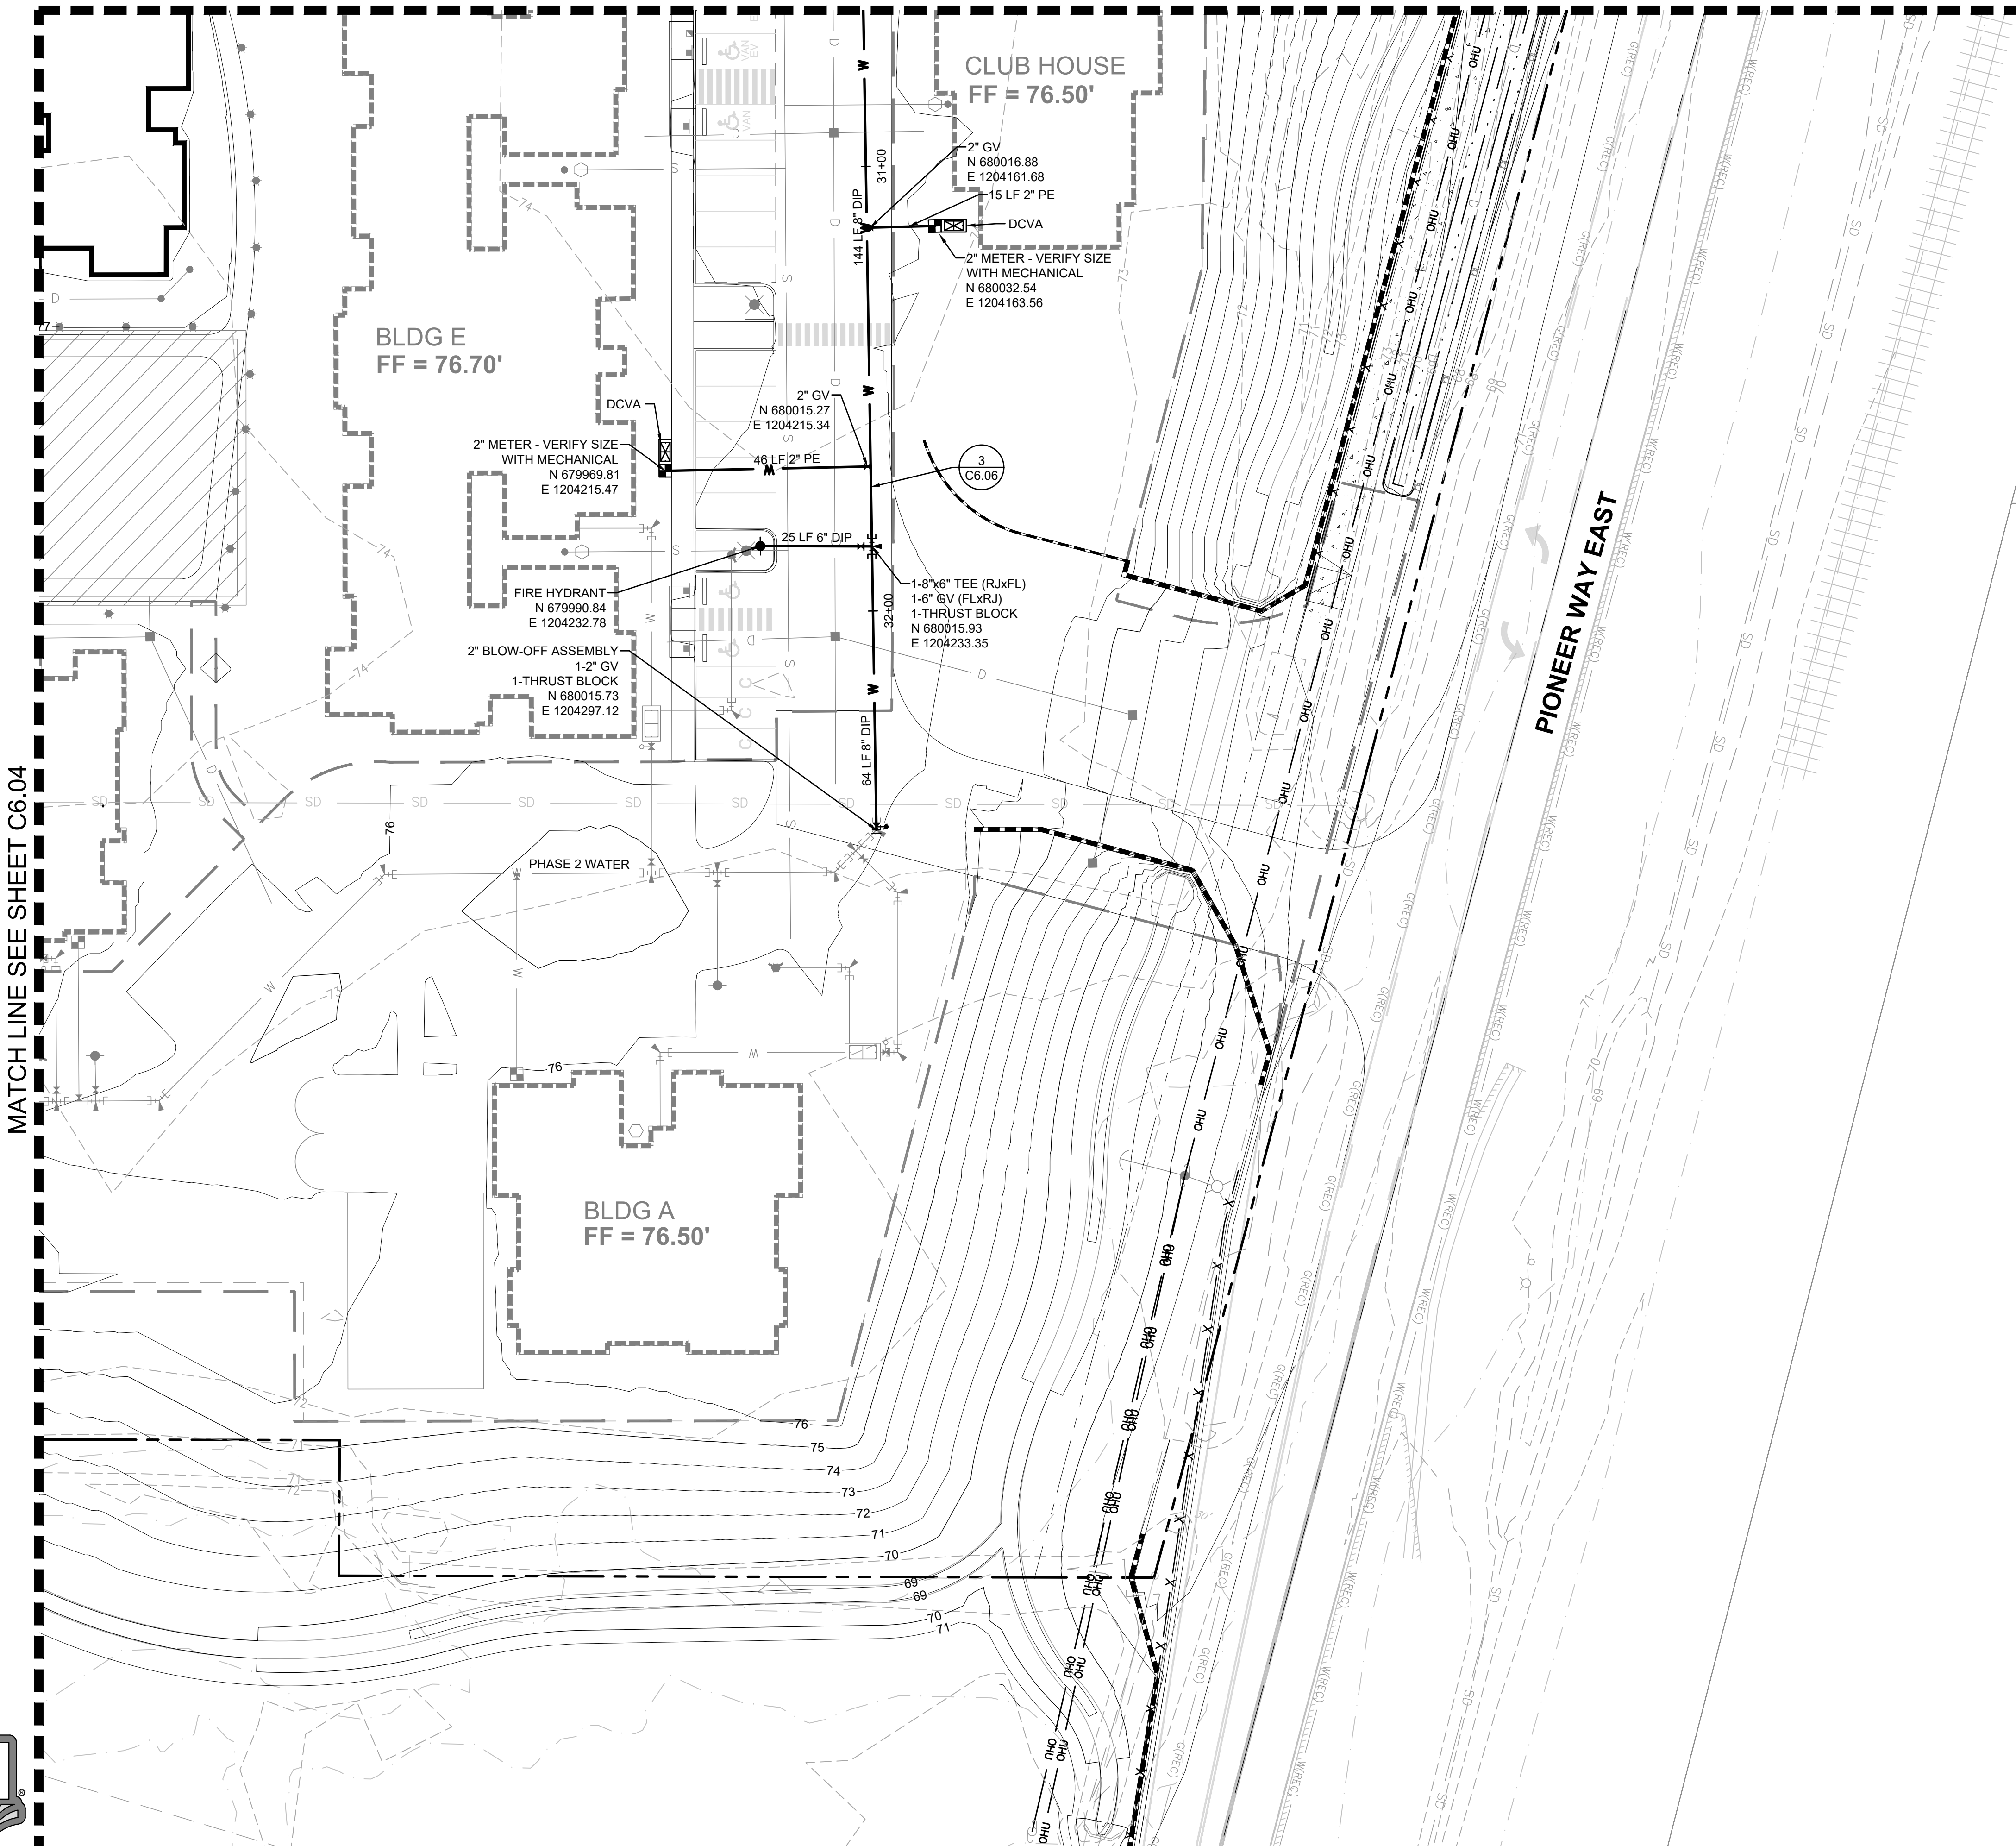

### GENERAL NOTES

- WET TAPS TO EXISTING WATER MAINS SHALL BE ACCOMPLISHED THROUGH A TAPPING TEE AND TAPPING VALVE, AND SHALL BE MADE BY A CITY APPROVED CONTRACTOR. THE TAPPING SLEEVE SHALL BE ROMAC SST ALL STAINLESS STEEL TAPPING SLEEVE OR APPROVED EQUAL. A TWO-PIECE EPOXY COATED OR DUCTILE IRON TAPPING SLEEVE MAY BE USED ON DUCTILE IRON PIPE, WHEN THE TAP IS SMALLER THAN THE WATER MAIN, I.E. 6" TAP ON 8" PIPE. THE CITY SHALL APPROVE THE TIME AND LOCATION FOR THESE CONNECTIONS.
- IF THE PROJECT IS UTILIZING A FIRE BOOSTER PUMP, THE FDC MUST CONNECT TO THE SPRINKLER SYSTEM ON THE DISCHARGE SIDE OF THE PUMP IN ACCORDANCE WITH NFPA REGULATIONS.

### DETAIL REFERENCES

- HORIZONTAL THRUST BLOCKING (1) C6.09
- VERTICAL THRUST BLOCKING (2) C6.09
- THRUST BLOCKING TABLE (3) C6.09
- 3/4" OR 1" WATER SERVICE CONNECTION (4) C6.09
- 1-1/2" OR 2" WATER SERVICE CONNECTION (5) C6.09
- PRIVATE WATER SERVICE LINES (6) C6.09
- 2" AND SMALLER DCVA INSTALLATION (7) C6.09
- FIRE HYDRANT ASSEMBLY (8) C6.09
- 2" BLOW-OFF ASSEMBLY (1) C6.10
- DDCVA ASSEMBLY AND NOTES (2) C6.10 (3) C6.10
- FIRE DEPARTMENT CONNECTION (4) C6.10
- POST INDICATOR VALVE (5) C6.10
- WATER VALVES AND MAINS (1) C6.11
- WATER MAIN CROSSING OTHER UTILITIES AND NOTES (2) C6.11 (3) C6.11
- 2" AND SMALLER RPBA ASSEMBLY INSTALLATION (4) C6.11
- WATER VAULT DETAILS (5) C6.11

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024




NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OR WARRANTY BY THE ENGINEER OR ARCHITECT FOR THE PROJECT DESCRIBED IN THE TITLE BLOCK AND IS NOT TO BE USED FOR OTHER PROJECTS OR IN ADDITION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

- 03/29/24 CITY COMMENTS
  - 01/29/24 CITY COMMENTS
- Revisions:

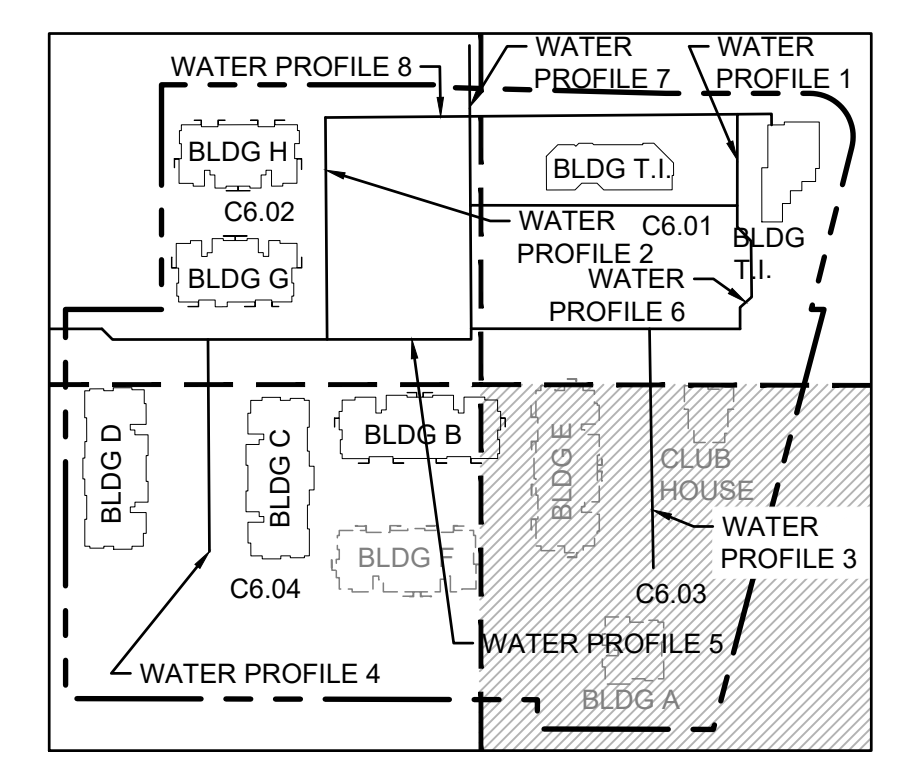

Sheet Title:  
**WATER PLAN NE**

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI


Sheet No.  
**C6.03**  
 44 of 53 Sheets





# EAST TOWN CROSSING PHASE 1


## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

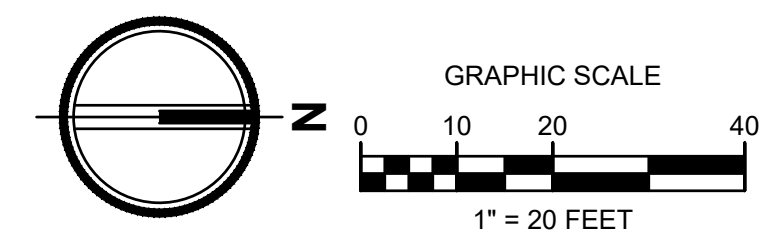

FIRE HYDRANT/FDC LOCATION/ACCESS APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 FIRE CODE OFFICIAL  
 DATE: 06/04/2024

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 1 YEAR FROM APPROVAL DATE.  
 THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.  
 FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE FIRE CODE OFFICIAL.

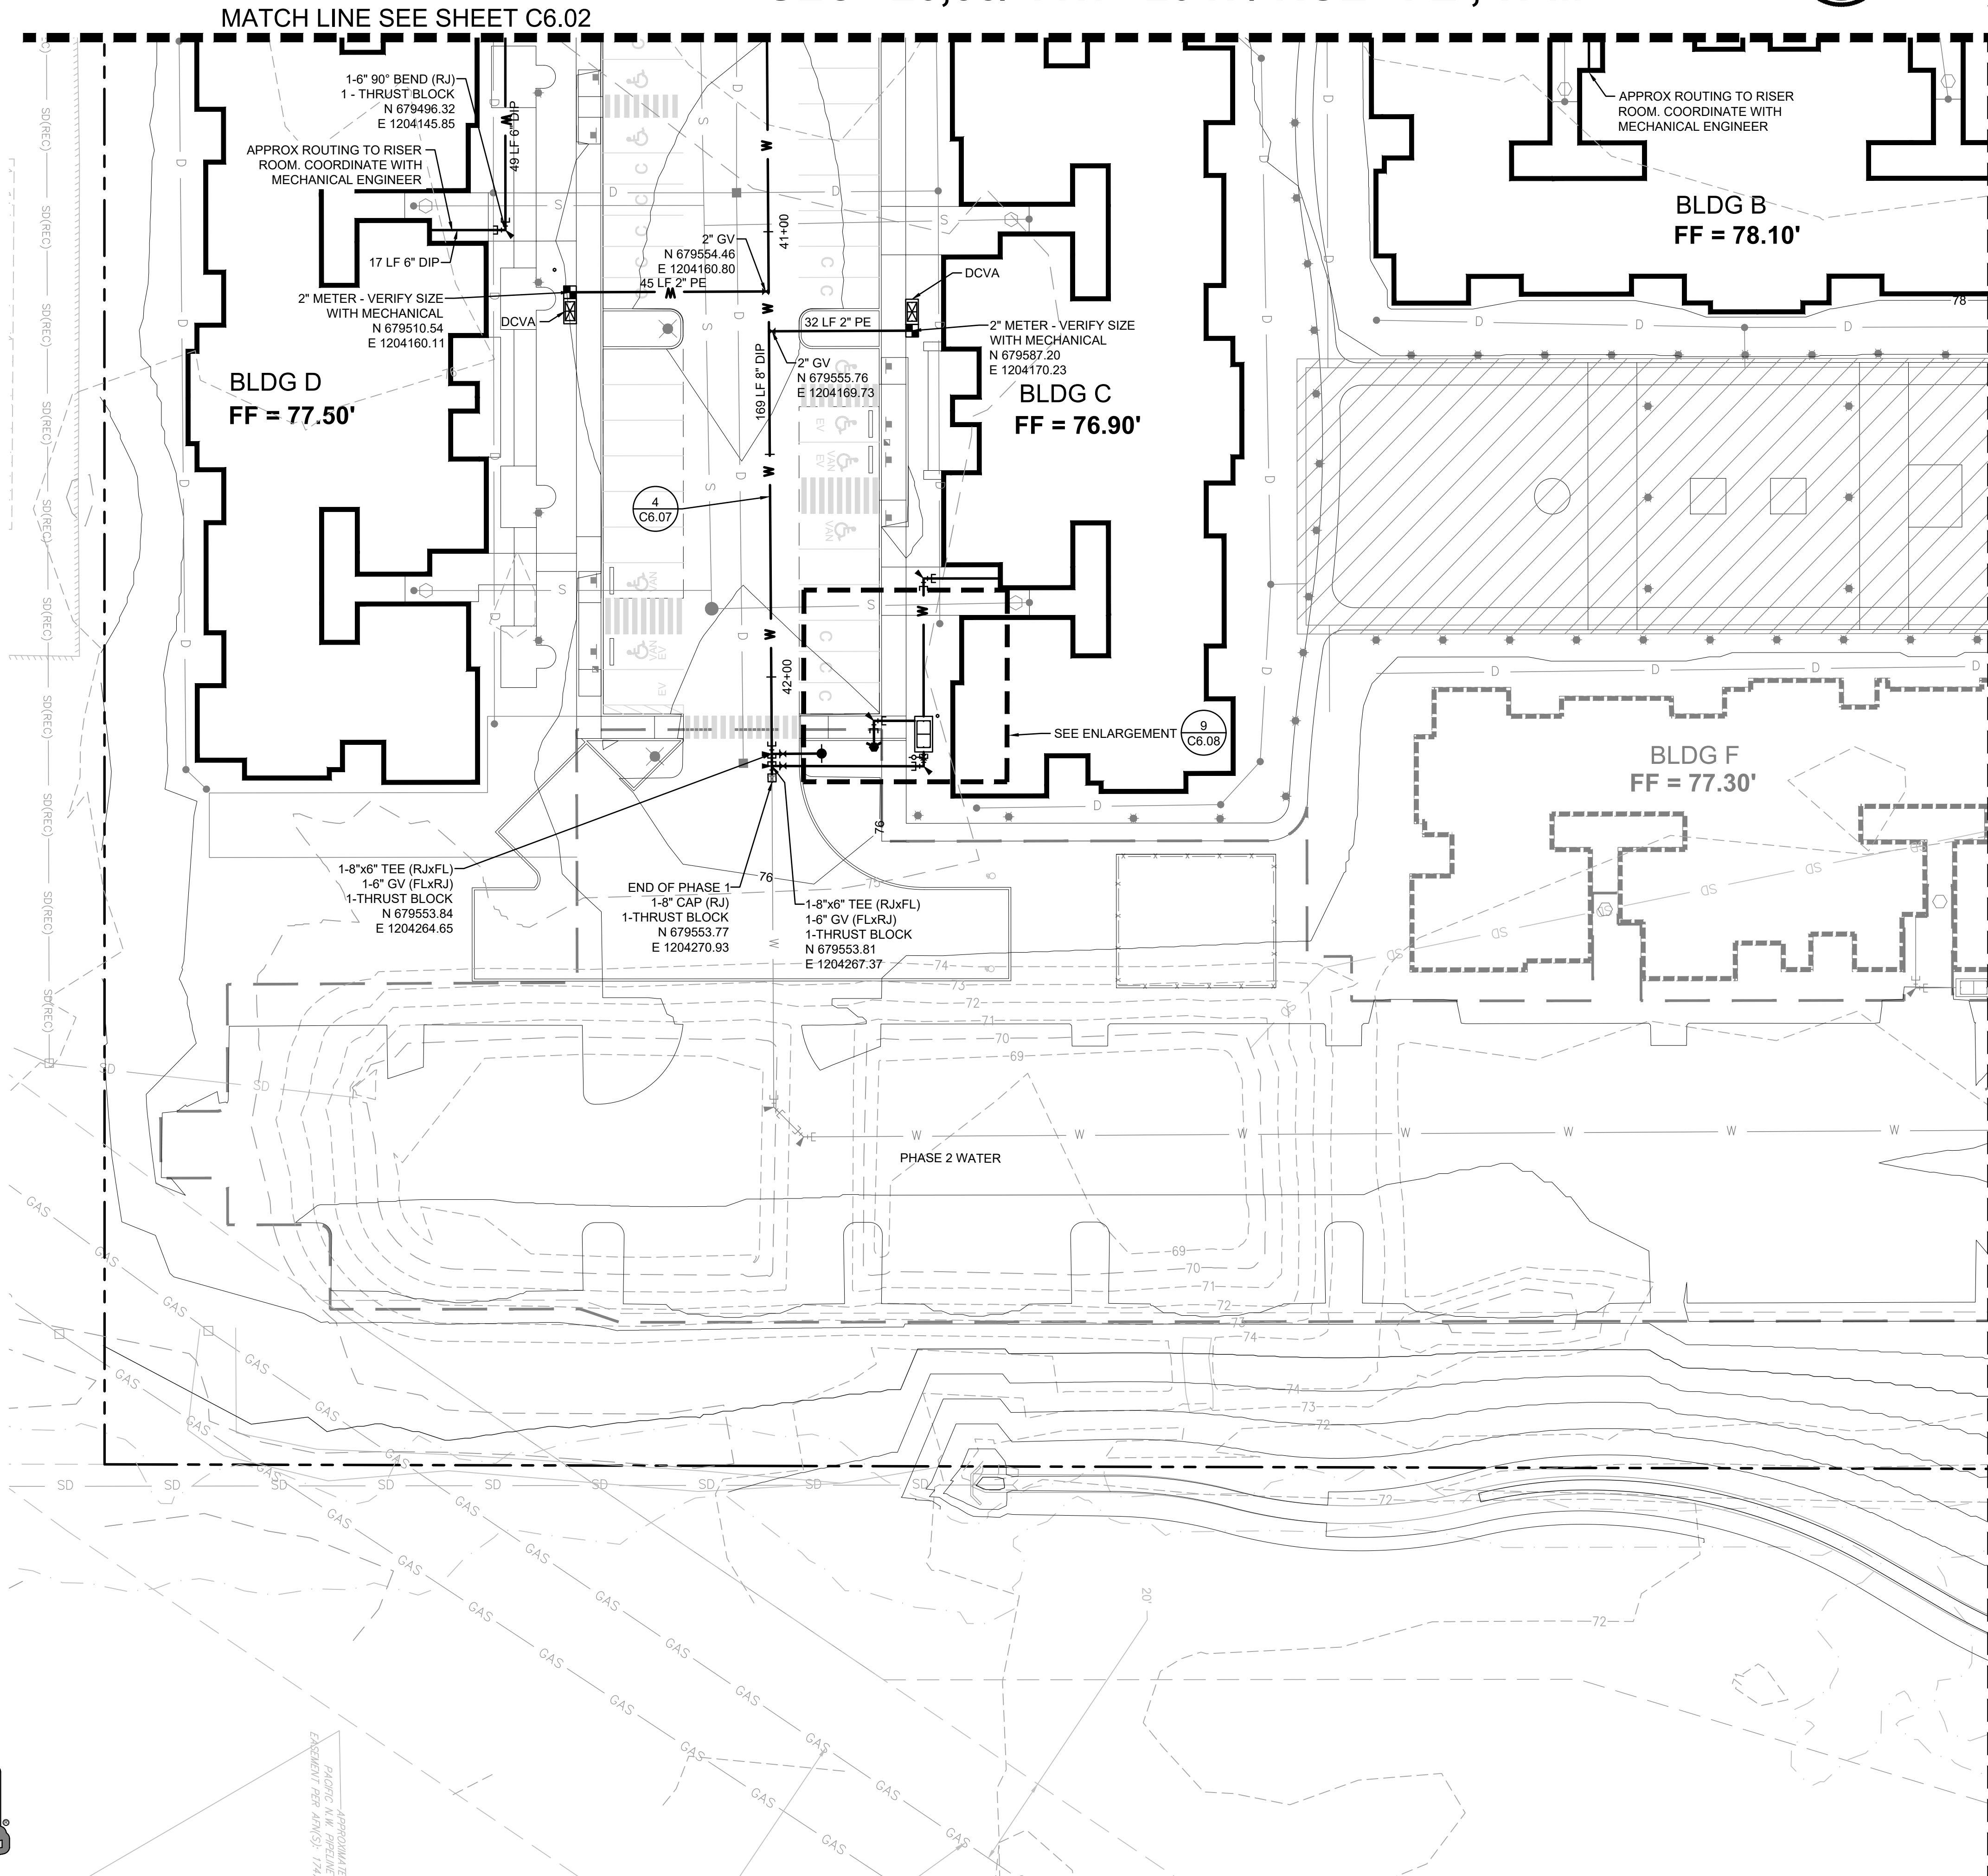


### GENERAL NOTES

- WET TAPS TO EXISTING WATER MAINS SHALL BE ACCOMPLISHED THROUGH A TAPPING TEE AND TAPPING VALVE, AND SHALL BE MADE BY A CITY APPROVED CONTRACTOR. THE TAPPING SLEEVE SHALL BE ROMAC SST ALL STAINLESS STEEL TAPPING SLEEVE OR APPROVED EQUAL. A TWO-PIECE EPOXY COATED OR DUCTILE IRON TAPPING SLEEVE MAY BE USED ON DUCTILE IRON PIPE, WHEN THE TAP IS SMALLER THAN THE WATER MAIN, I.E. 6" TAP ON 8" PIPE. THE CITY SHALL APPROVE THE TIME AND LOCATION FOR THESE CONNECTIONS.
- IF THE PROJECT IS UTILIZING A FIRE BOOSTER PUMP, THE FDC MUST CONNECT TO THE SPRINKLER SYSTEM ON THE DISCHARGE SIDE OF THE PUMP IN ACCORDANCE WITH NFPA REGULATIONS.

### DETAIL REFERENCES

- HORIZONTAL THRUST BLOCKING 1 C6.09
- VERTICAL THRUST BLOCKING 2 C6.09
- THRUST BLOCKING TABLE 3 C6.09
- 3/4" OR 1" WATER SERVICE CONNECTION 4 C6.09
- 1-1/2" OR 2" WATER SERVICE CONNECTION 5 C6.09
- PRIVATE WATER SERVICE LINES 6 C6.09
- 2" AND SMALLER DCVA INSTALLATION 7 C6.09
- FIRE HYDRANT ASSEMBLY 8 C6.09
- 2" BLOW-OFF ASSEMBLY 1 C6.10
- DCVA ASSEMBLY AND NOTES 2 C6.10 3 C6.10
- FIRE DEPARTMENT CONNECTION 4 C6.10
- POST INDICATOR VALVE 5 C6.10
- WATER VALVES AND MAINS 1 C6.11
- WATER MAIN CROSSING OTHER UTILITIES AND NOTES 2 C6.11 3 C6.11
- 2" AND SMALLER RPBA ASSEMBLY INSTALLATION 4 C6.11
- WATER VAULT DETAILS 5 C6.11

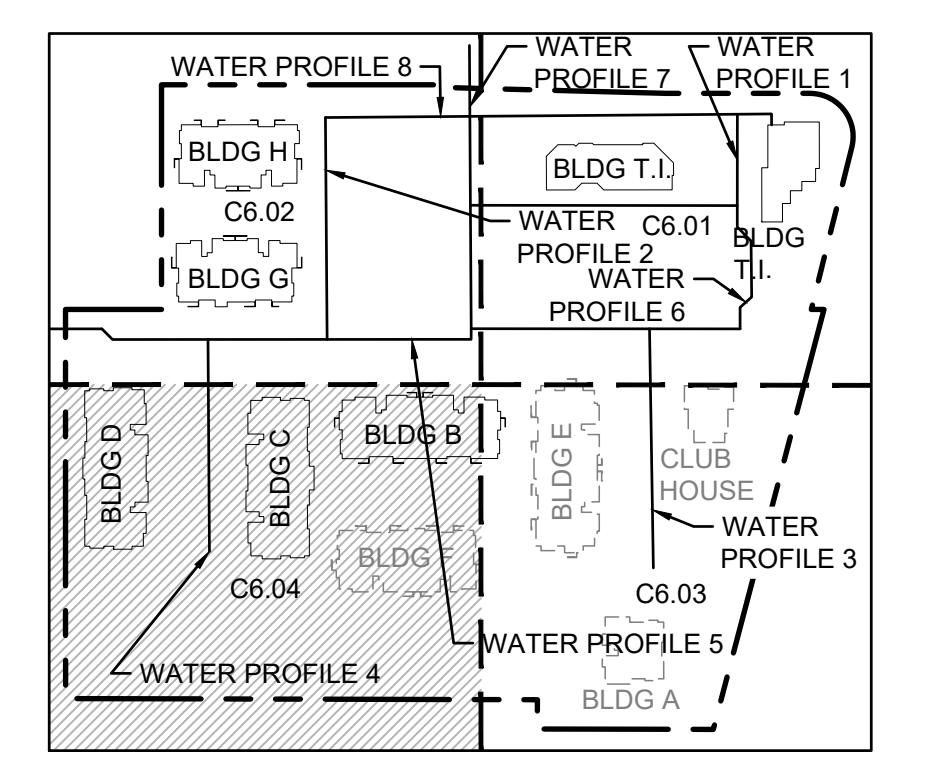

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
 PERMIT SUBMITTAL

05/17/2024



NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A PROFESSIONAL CHECK OR REVIEW BY THE ENGINEER OR THE SEAL HAS NOT TO BE USED FOR OTHER PROJECTS OR IN ACCORDANCE TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

- 03/29/24 CITY COMMENTS
  - 01/29/24 CITY COMMENTS
- Revisions:

Sheet Title:  
**WATER PLAN SE**

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI

Sheet No.  
**C6.04**  
 45 of 53 Sheets






# EAST TOWN CROSSING PHASE 1


## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

FIRE HYDRANT/FDC LOCATION/ACCESS APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 FIRE CODE OFFICIAL  
 DATE: 06/04/2024


APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

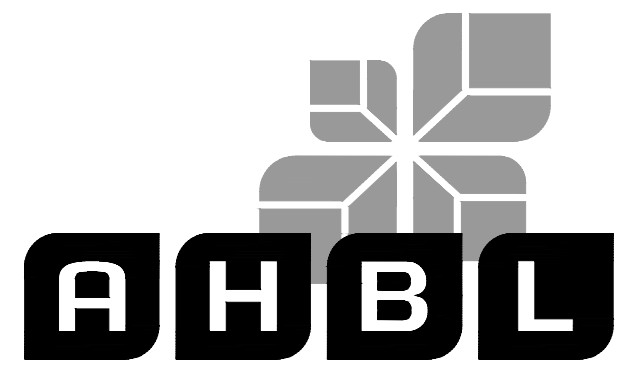


TACOMA · SEATTLE · SPOKANE · TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

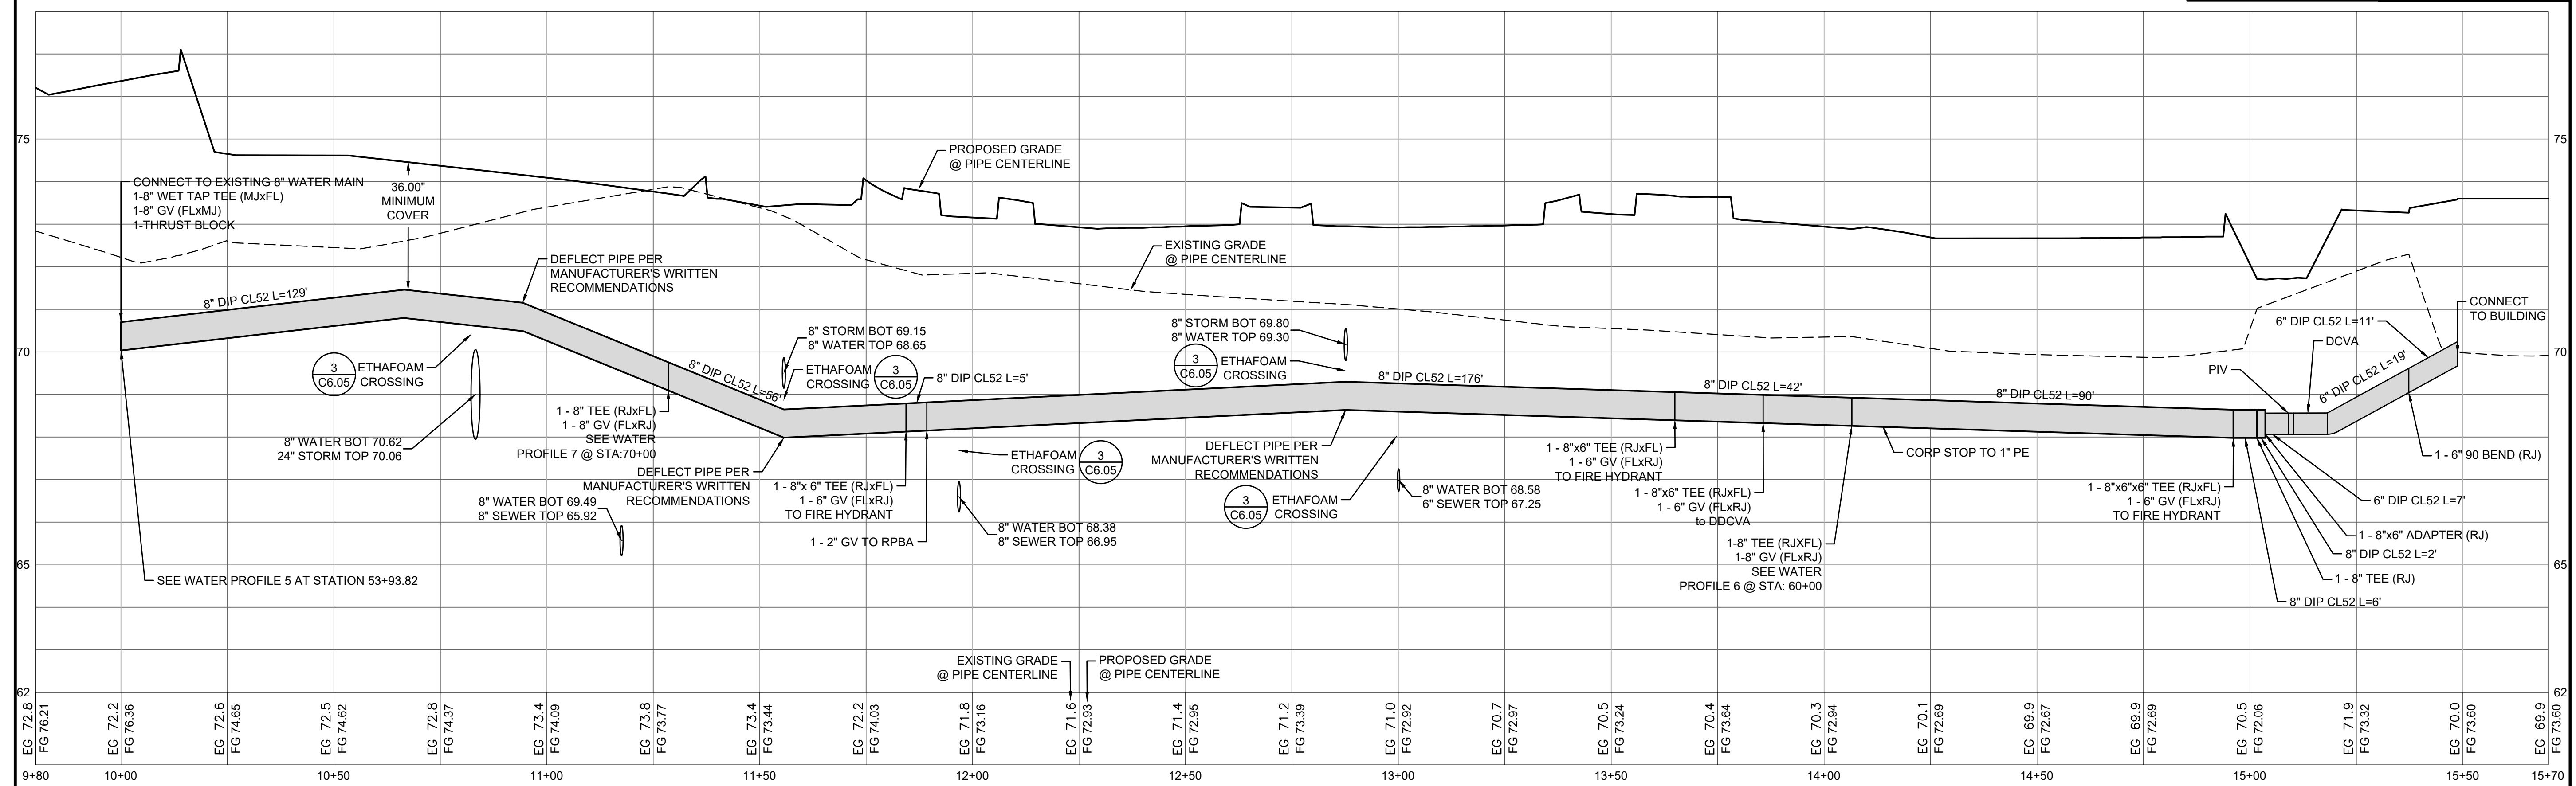

**1 WATER PROFILE 1**  
 1"=2" VERTICAL, 1"=20' HORIZONTAL

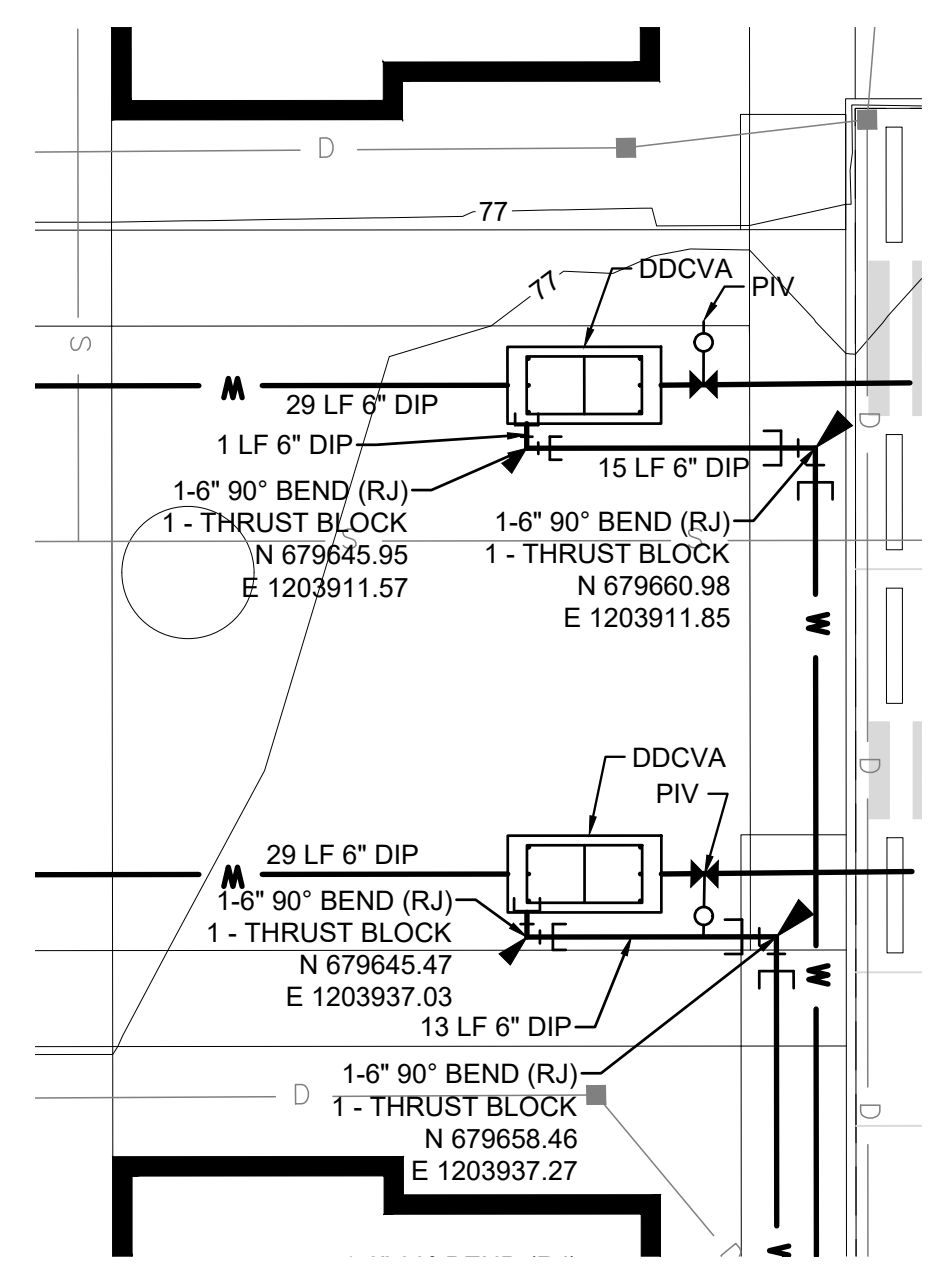


**2 ENLARGEMENT**  
 SCALE: 1"=10"

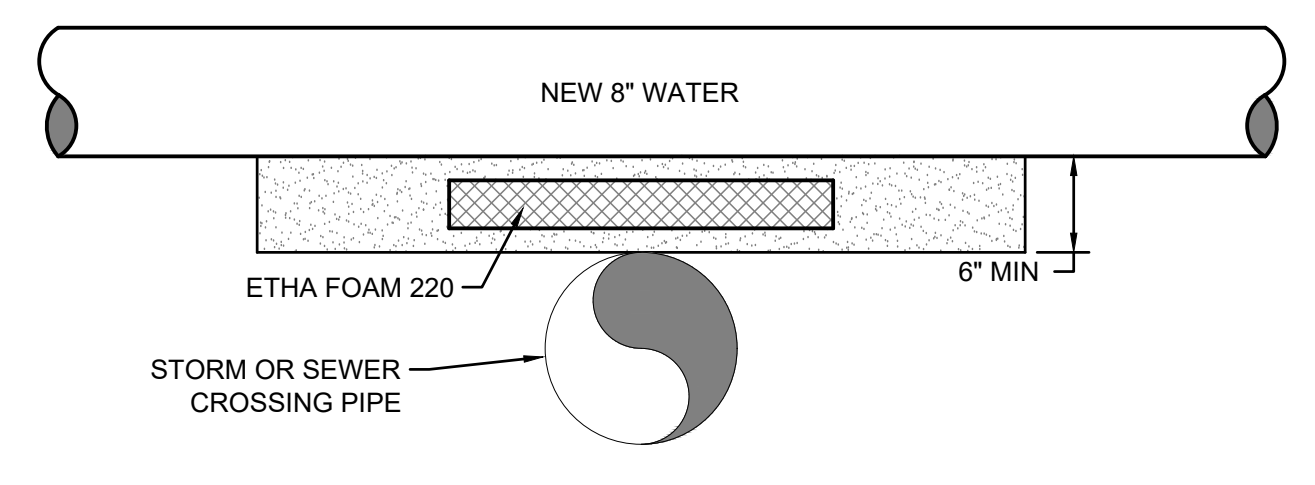


FOR CROSSINGS LESS THAN 12" (18" FOR SEWER AND WATER CROSSINGS), A 3"x48"x108" SHEET OF ETHAFOAM 220 WILL BE PLACED BETWEEN THE PIPES WITH SAND PLACED AROUND THE CROSSING PIPES AND ETHAFOAM SHEET. SEWER AND WATER CROSSINGS SHALL MEET THE 2008 CRITERIA FOR SEWAGE WORKS DESIGN C1-9.1.4

SEE ADDITIONAL CROSSING REQUIREMENTS ON CITY OF PUYALLUP STANDARD DETAILS (C6.11, C6.11)

**3 ETHAFOAM DETAIL**  
 NOT TO SCALE

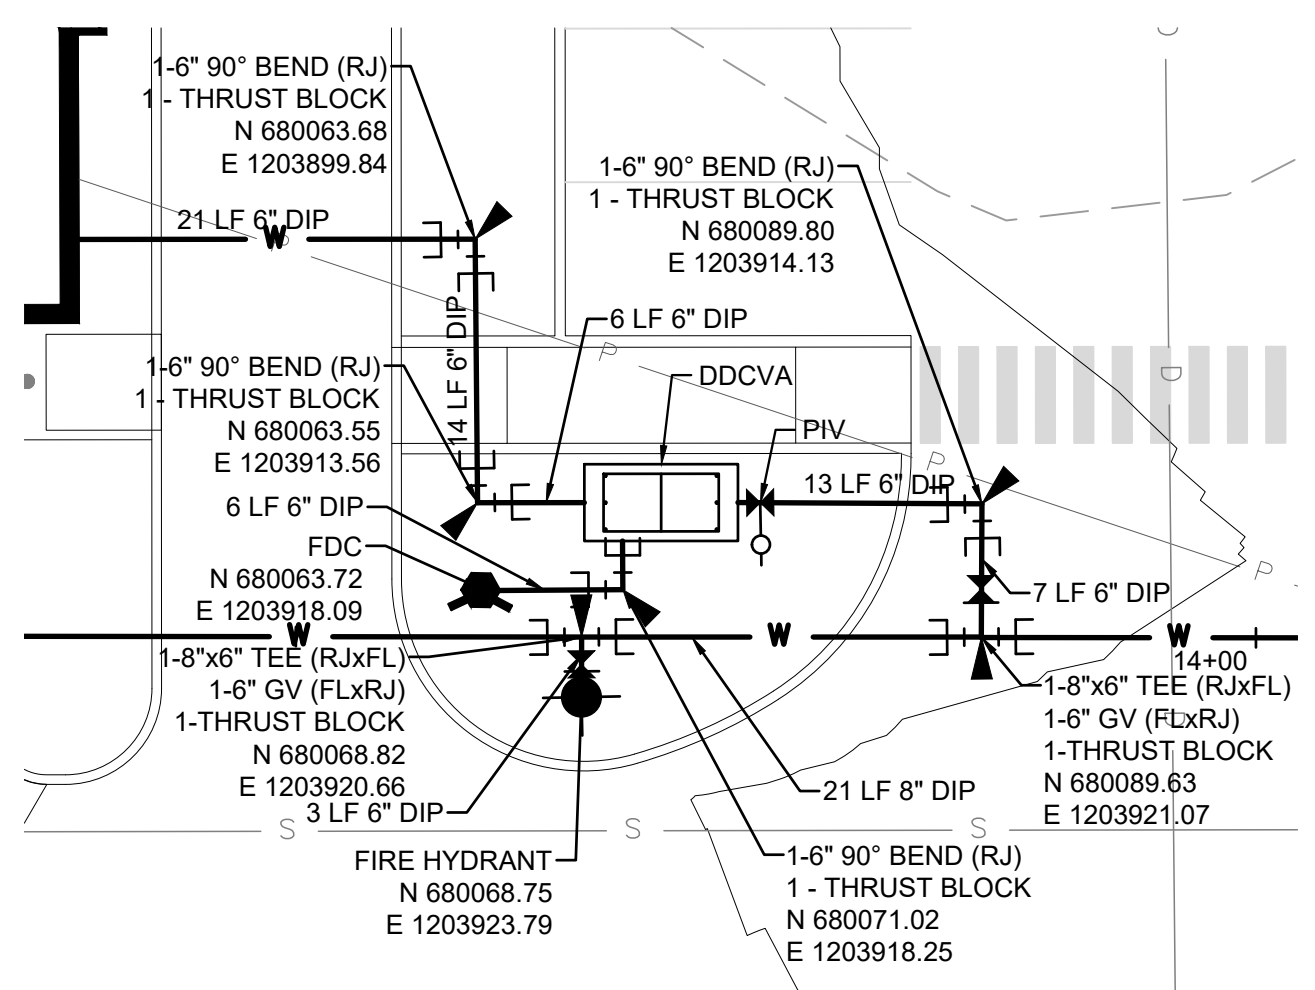

**4 ENLARGEMENT**  
 SCALE: 1"=10"

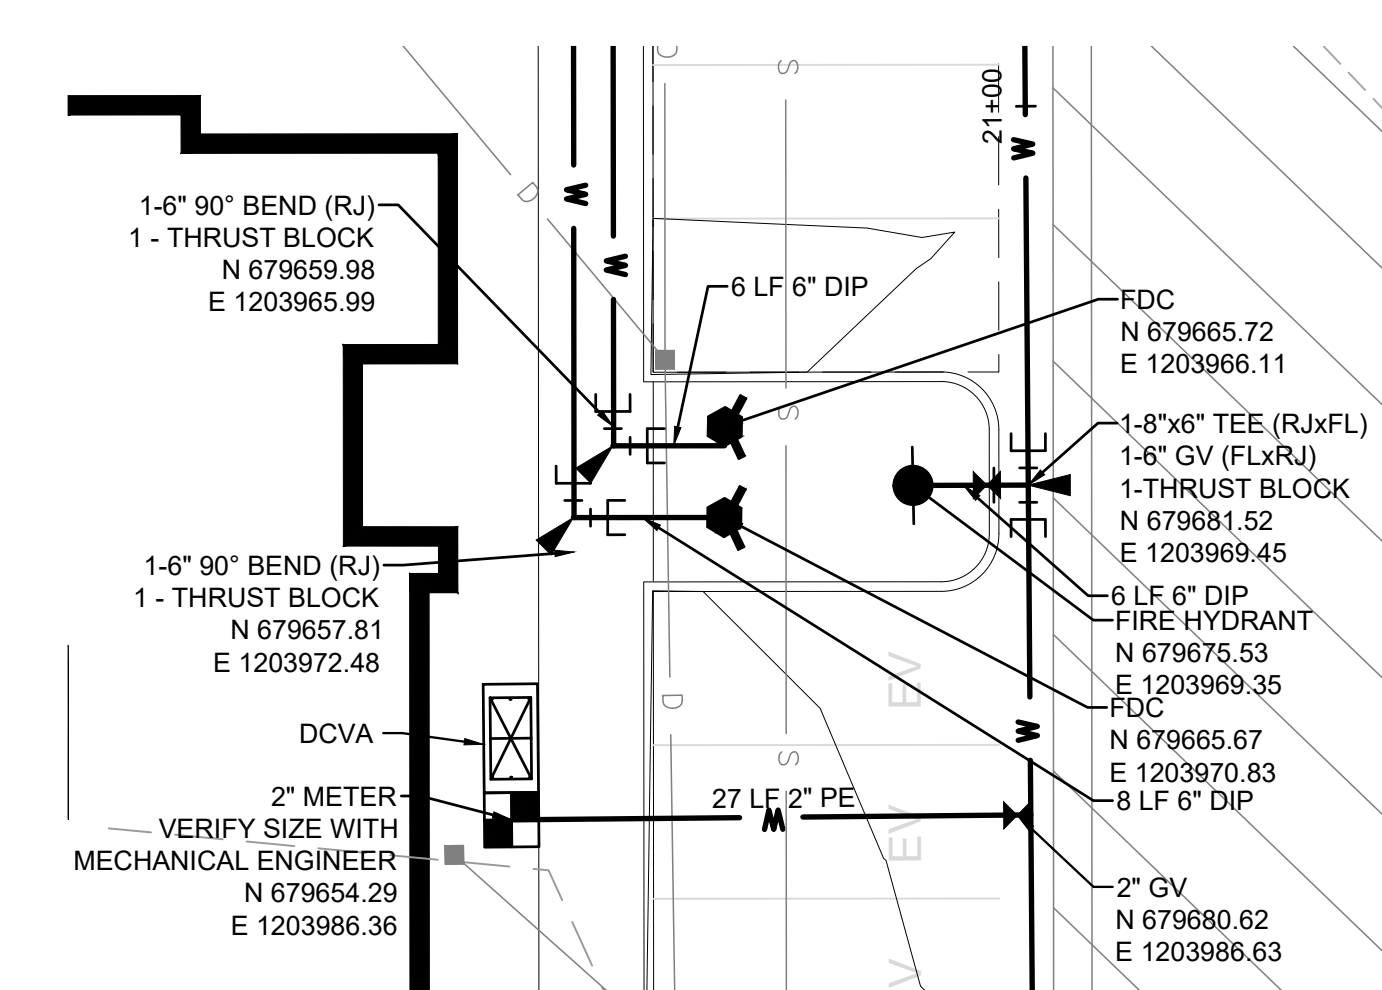

**5 ENLARGEMENT**  
 SCALE: 1"=10"

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
 PERMIT SUBMITTAL  
 05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A REVIEW OF THE PROJECT BY THE ENGINEER OR ARCHITECT FOR THE PROJECT EXCEPT IN THE TITLE BLOCK AND IS NOT TO BE USED FOR OTHER PROJECTS OR ADDITION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title:  
**WATER PROFILES**

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI

Sheet No.  
**C6.05**  
 46 of 53 Sheets



Know what's below.  
 Call before you dig.




# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.


FIRE HYDRANT/FDC  
LOCATION/ACCESS APPROVED  
BY: *[Signature]*  
CITY OF PUYALLUP  
FIRE CODE OFFICIAL  
DATE: 06/04/2024

APPROVED  
BY: *[Signature]*  
CITY OF PUYALLUP  
DEVELOPMENT ENGINEERING  
DATE: 06/06/2024

NOTE: THIS APPROVAL IS VOID AFTER 1 YEAR FROM APPROVAL DATE.  
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.  
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

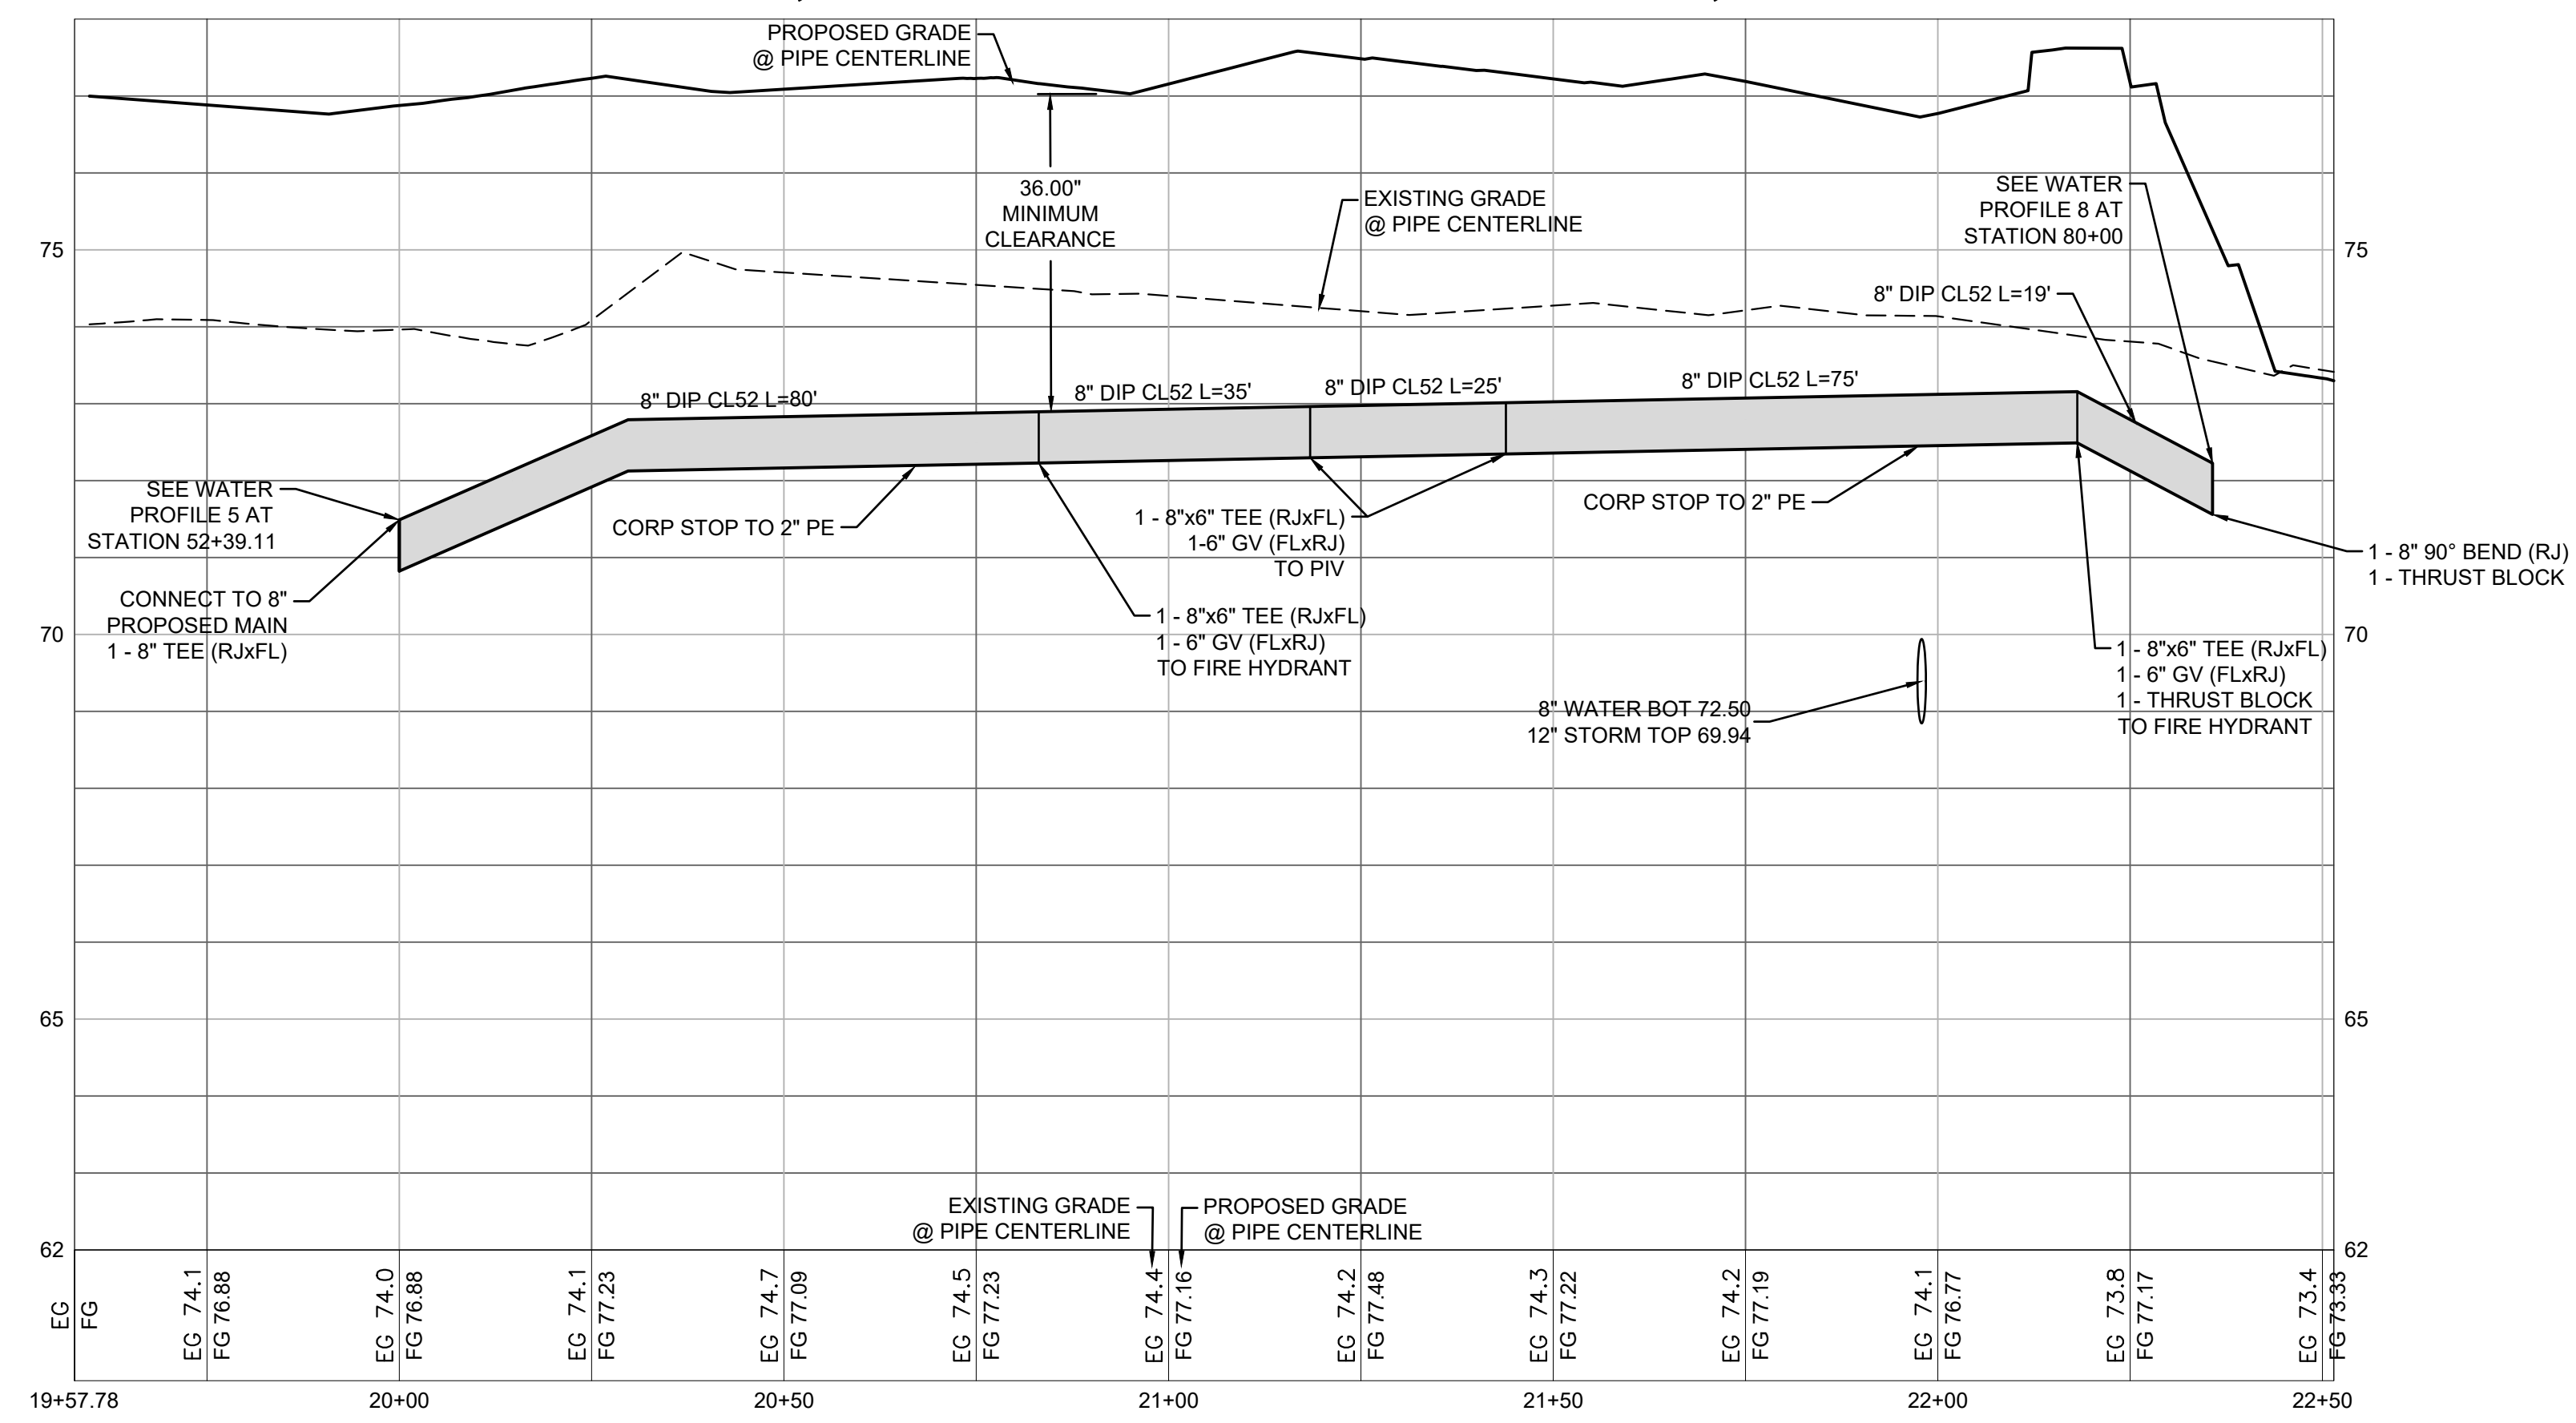

**2 WATER PROFILE 2**  
1"=2' VERTICAL, 1"=20' HORIZONTAL

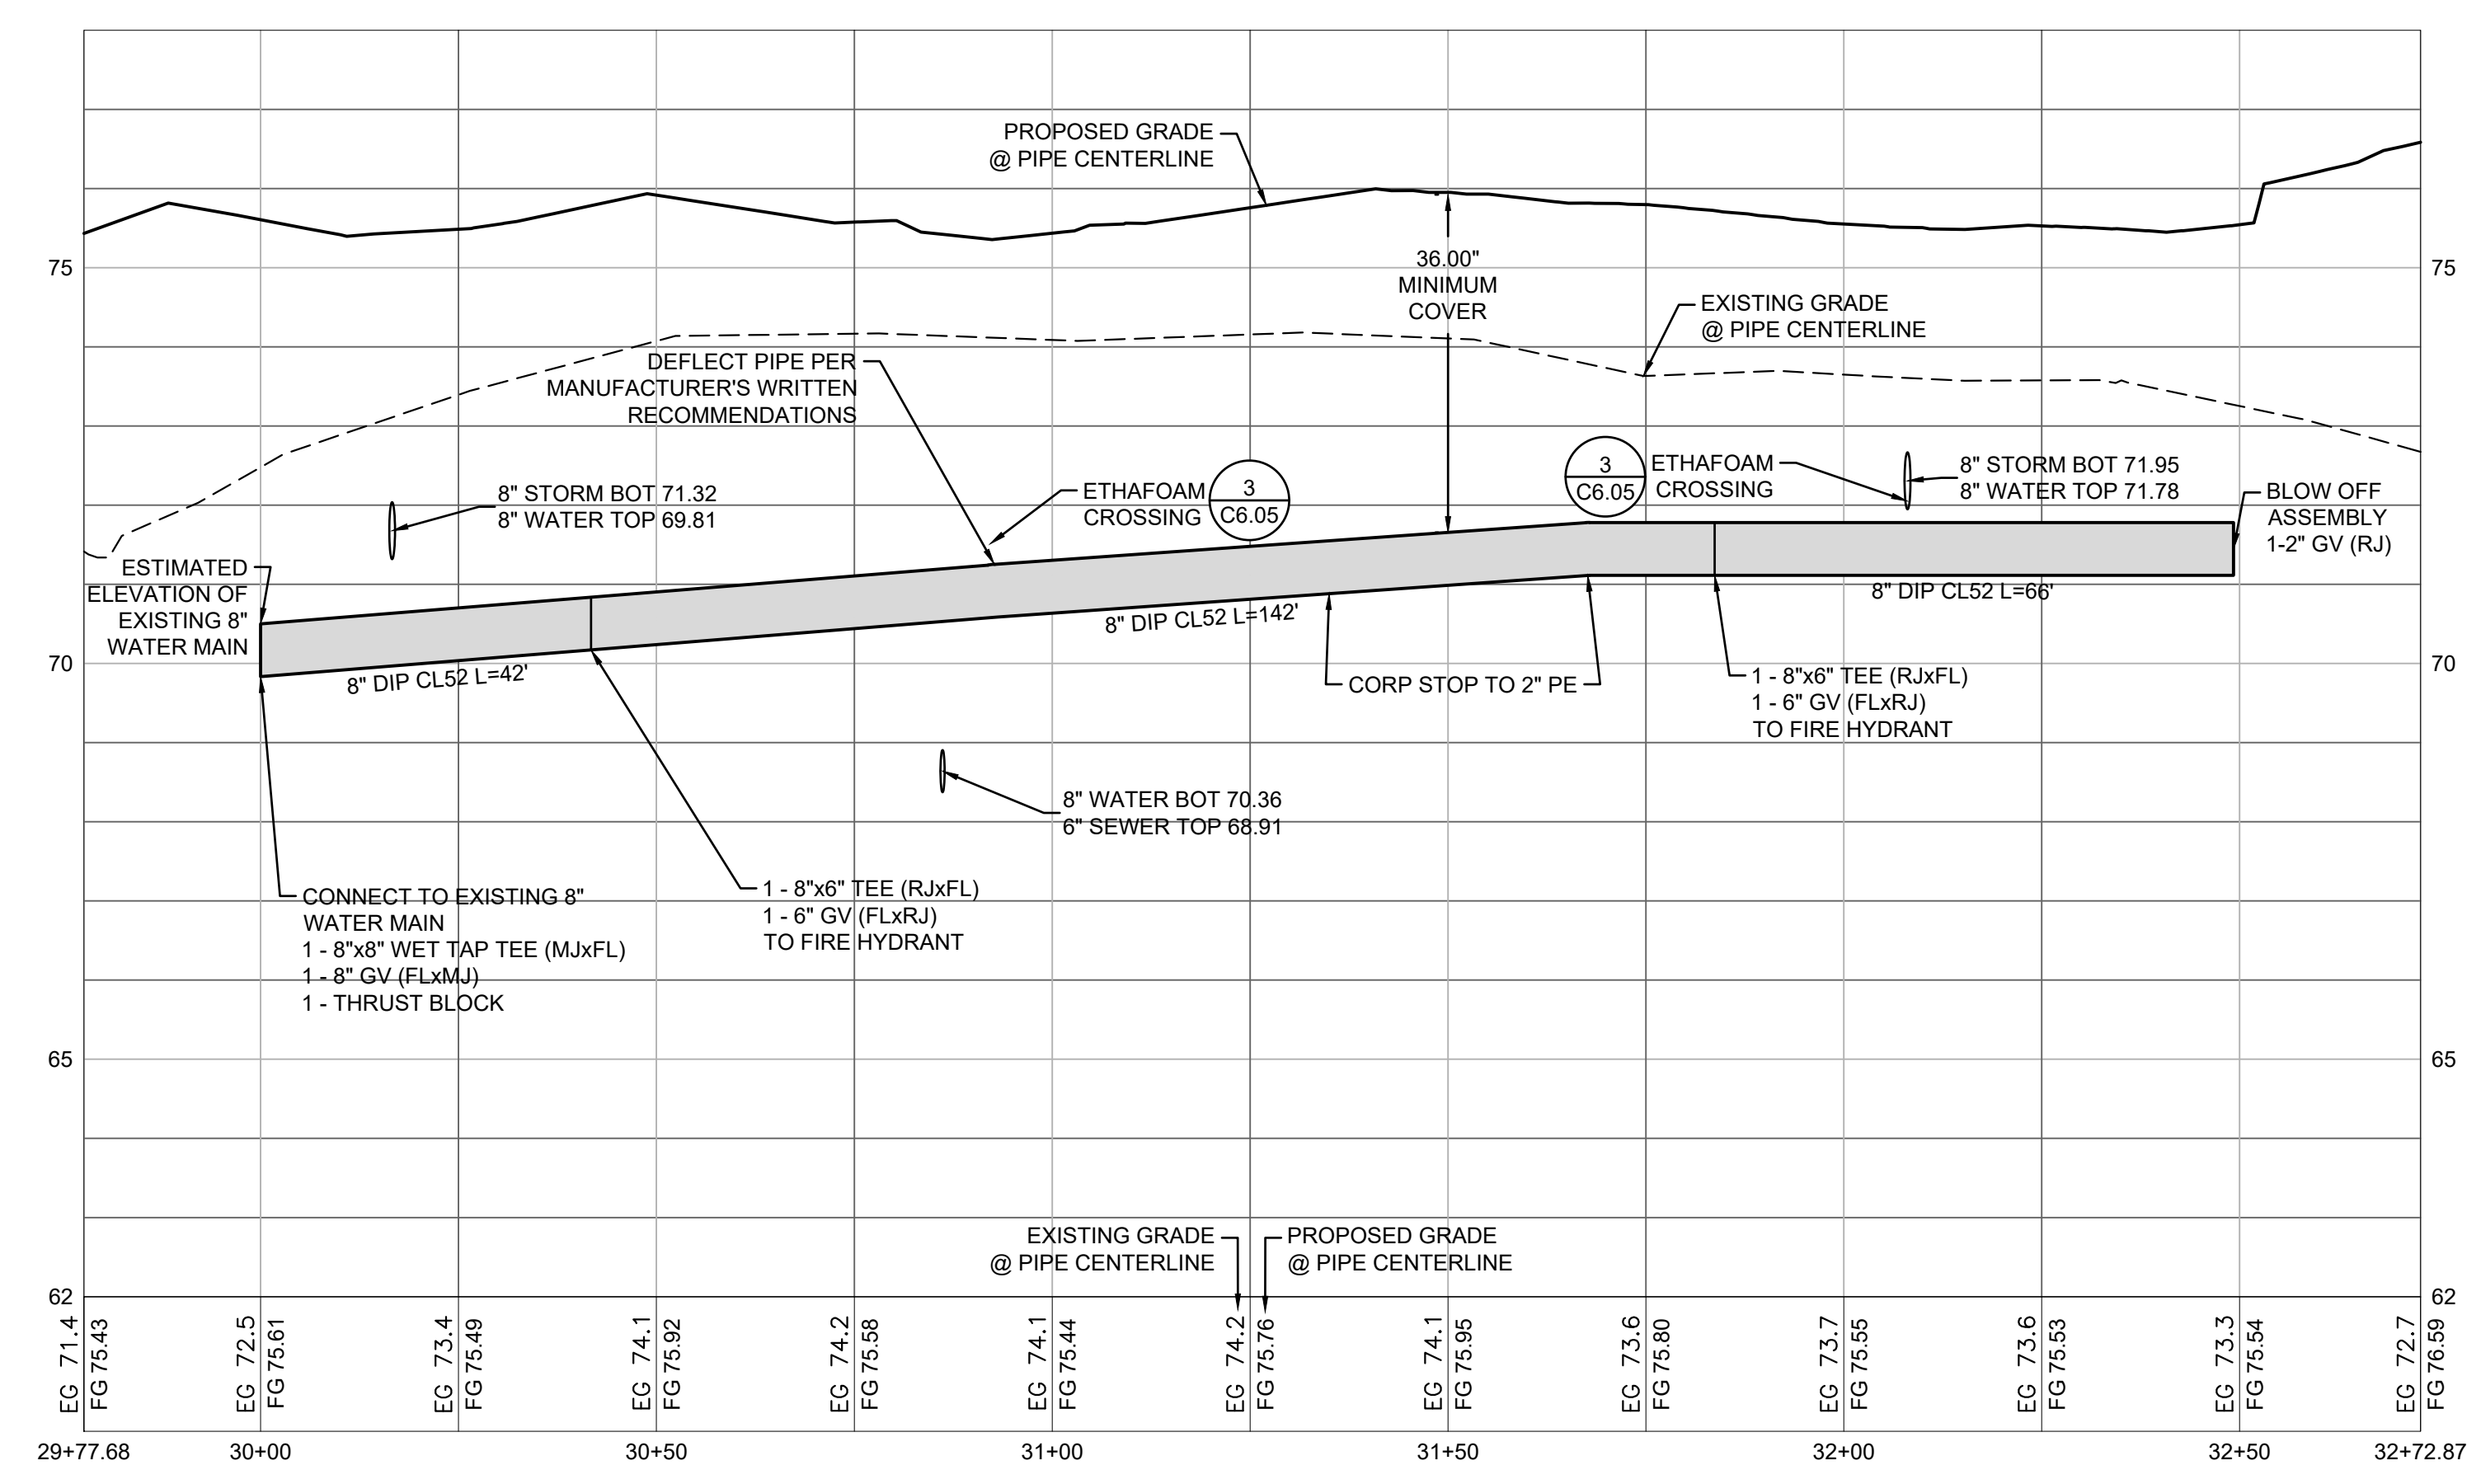


**3 WATER PROFILE 3**  
1"=2' VERTICAL, 1"=20' HORIZONTAL

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
ASH DEVELOPMENT  
  
GREG HELLE  
GREG.HELLE@ASHNW.COM

Project No.  
2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
04/09/2024

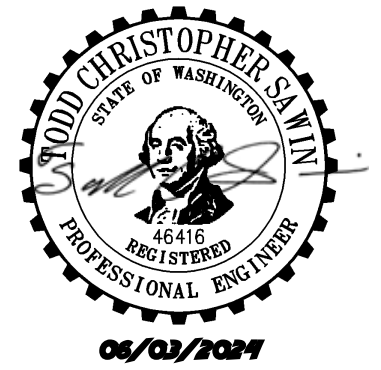

NOTICE: ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT REPRESENT THE DESIGNER'S CHECKED PRINTS OR THE DESIGNER'S OR THE ONLY FOR THE PROJECT DESCRIBED IN THE TITLE BLOCK AND IS NOT TO BE USED FOR OTHER PURPOSES OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

Revisions:  
03/29/24 CITY COMMENTS  
01/29/24 CITY COMMENTS

Sheet Title:  
**WATER PROFILES**

Designed by: CW  
Drawn by: SK / RS  
Checked by: JI

Sheet No.  
**C6.06**  
47 of 53 Sheets






# EAST TOWN CROSSING PHASE 1


## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

FIRE HYDRANT/FDC LOCATION/ACCESS APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 FIRE CODE OFFICIAL  
 DATE: 06/04/2024


APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

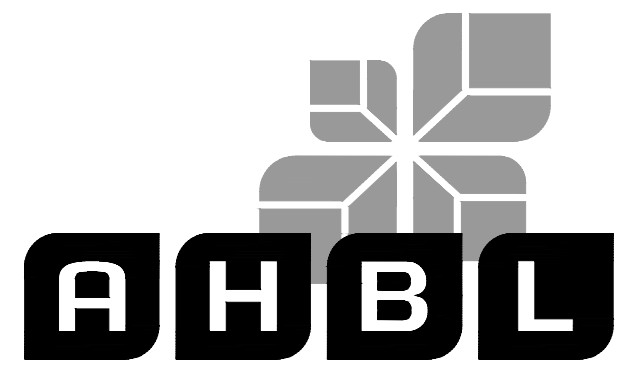

TACOMA · SEATTLE · SPOKANE · TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

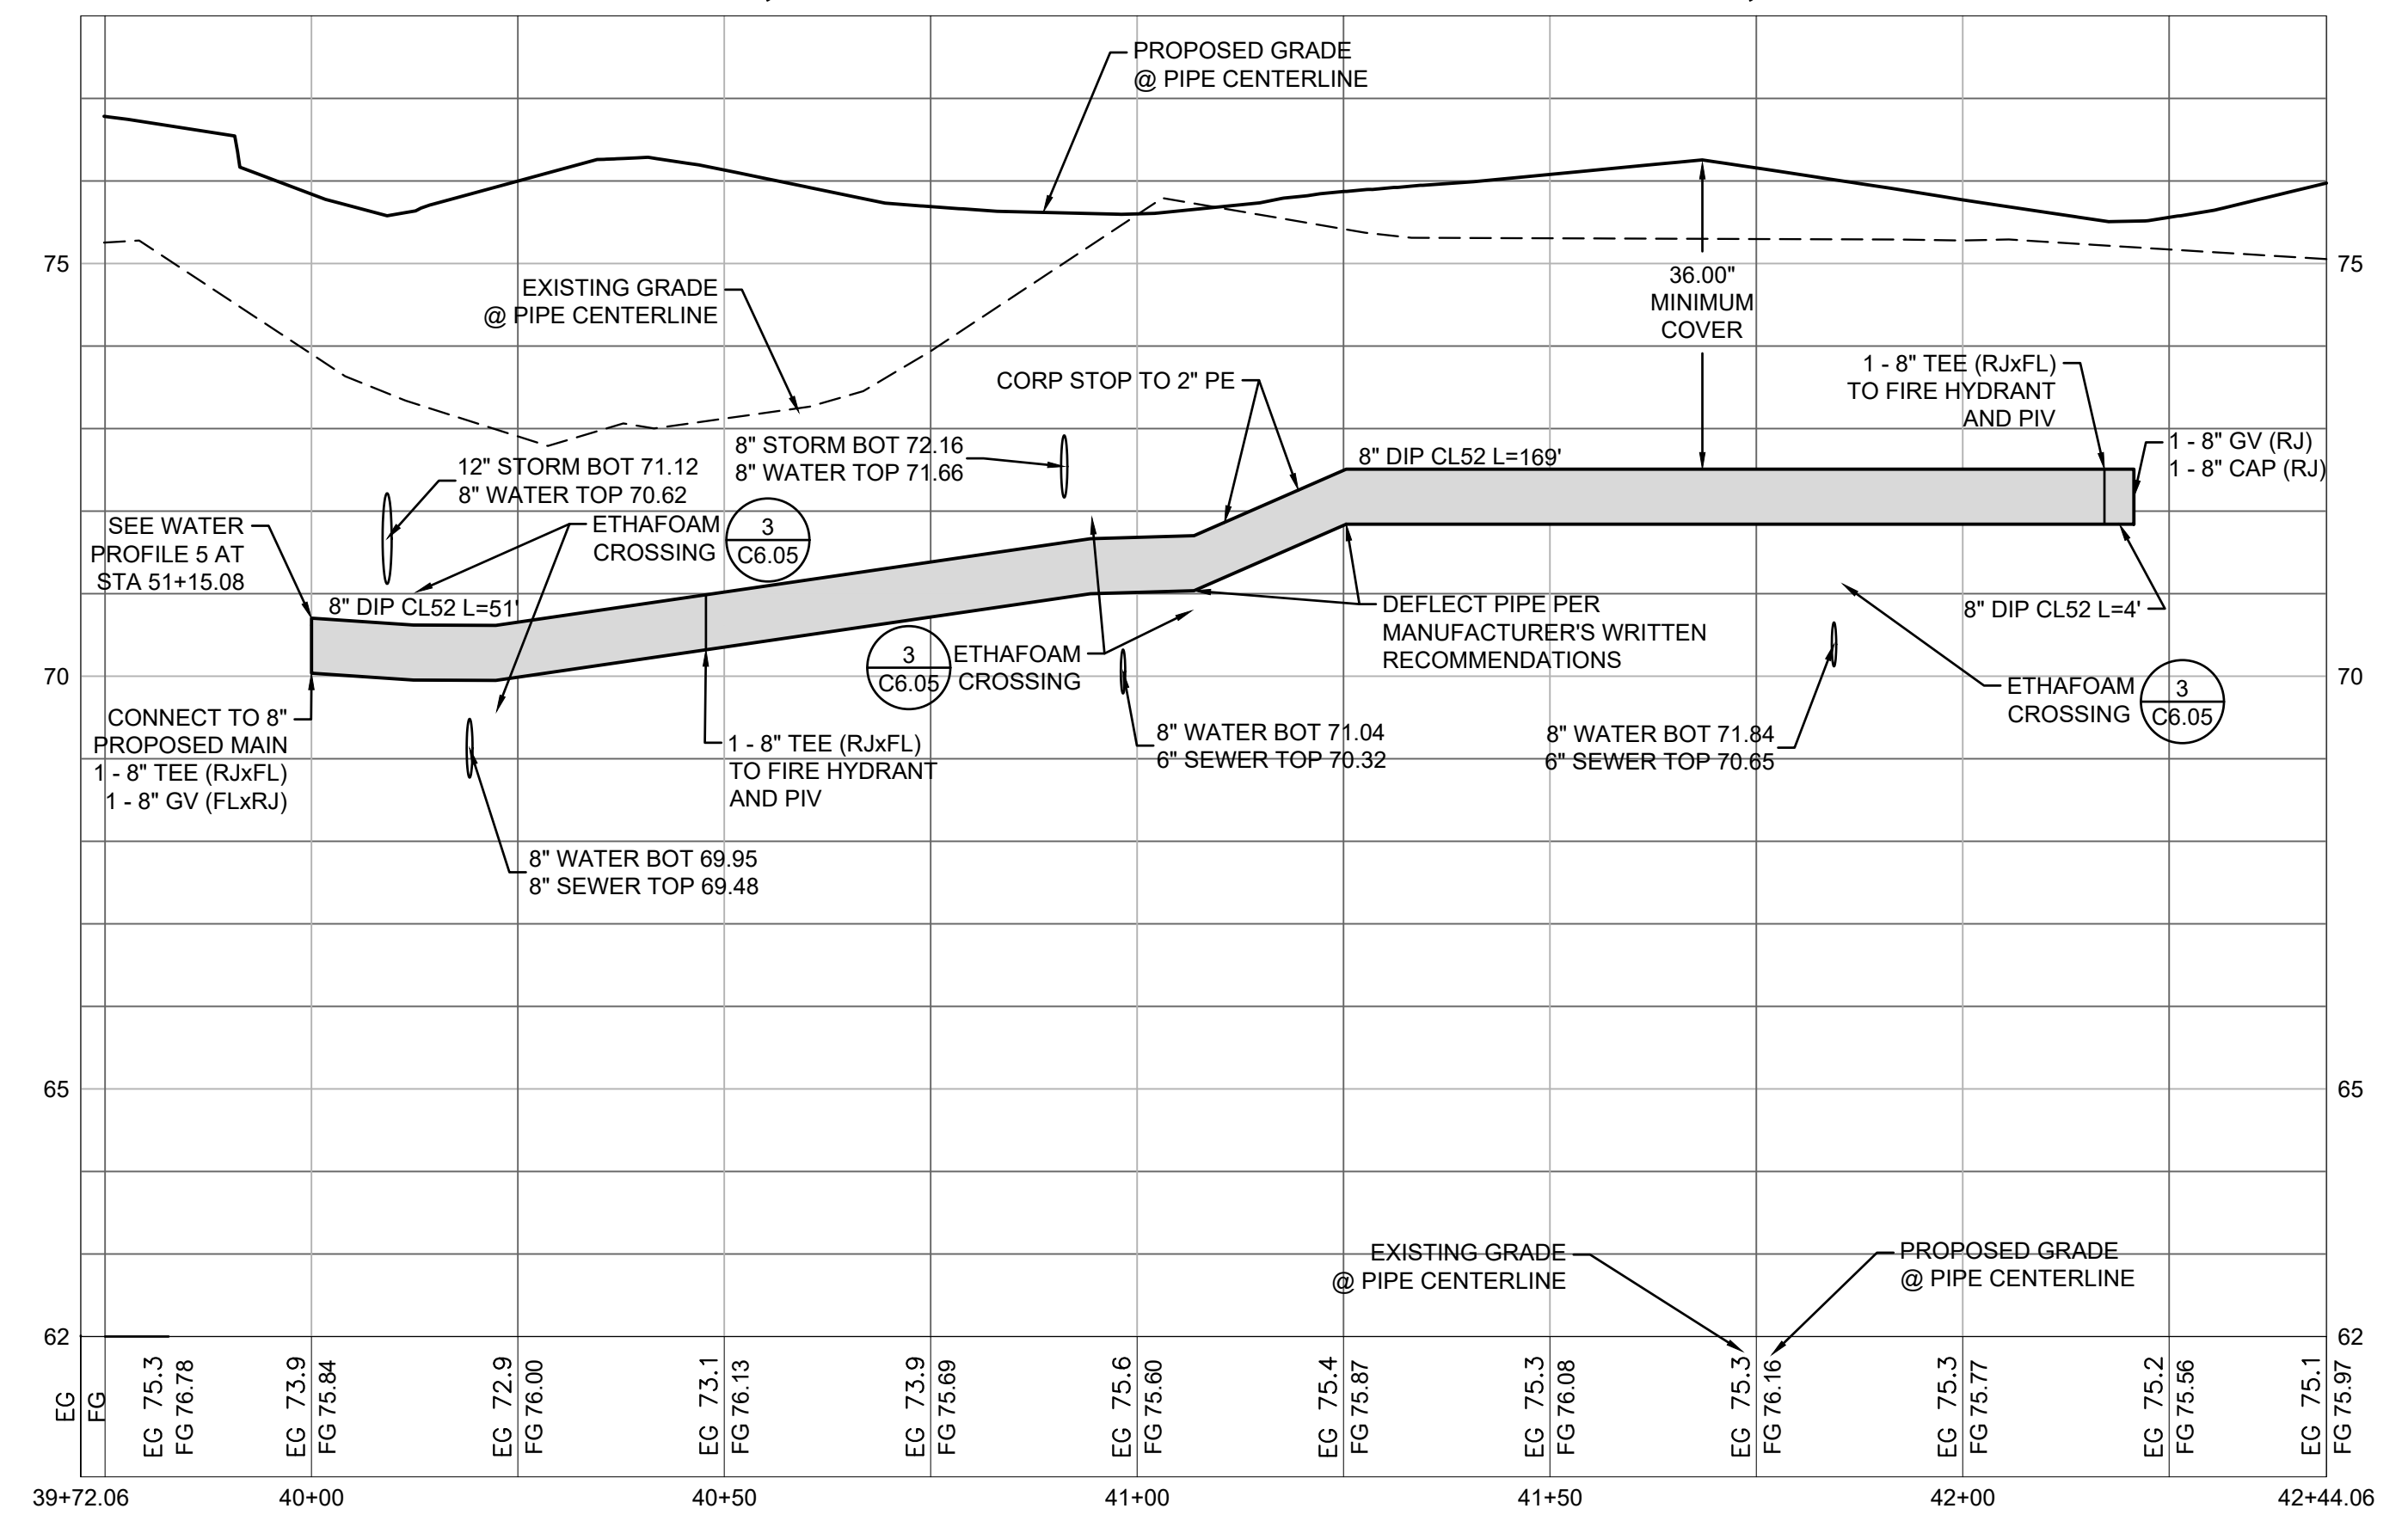

**4 WATER PROFILE 4**  
 1"=2' VERTICAL, 1"=20' HORIZONTAL

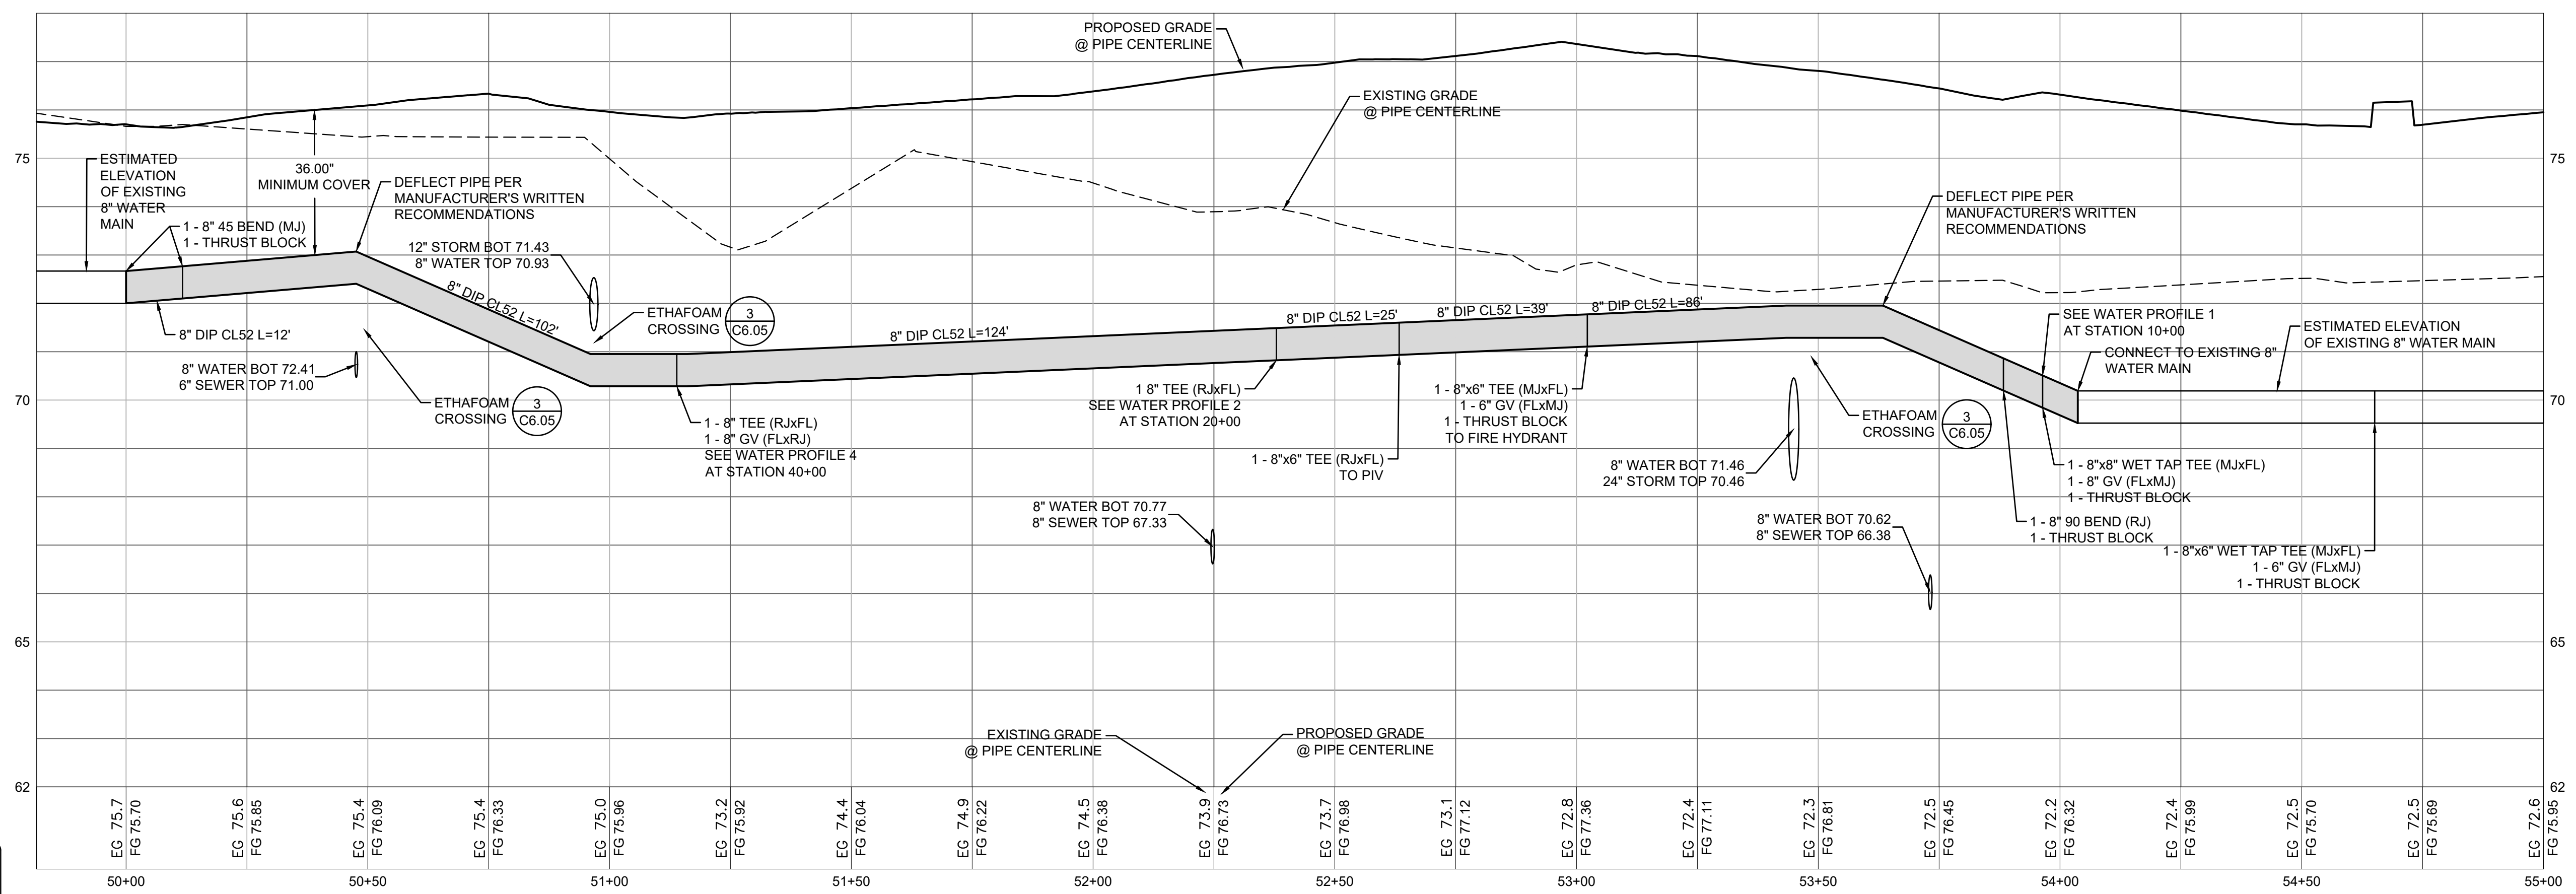

**5 WATER PROFILE 5**  
 1"=2' VERTICAL, 1"=20' HORIZONTAL



Know what's below.  
 Call before you dig.

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
 PERMIT SUBMITTAL

05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A PROFESSIONAL ENGINEER'S RESPONSIBILITY TO THE PUBLIC. THIS DOCUMENT IS FOR THE PROJECT IDENTIFIED IN THE TITLE BLOCK AND IS NOT TO BE USED FOR OTHER PROJECTS OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

- 03/29/24 CITY COMMENTS
  - 01/29/24 CITY COMMENTS
- Revisions:

Sheet Title:  
**WATER PROFILES**

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C6.07**  
 48 of 53 Sheets




# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

FIRE HYDRANT/FDC LOCATION/ACCESS APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 FIRE CODE OFFICIAL  
 DATE: 06/04/2024

APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

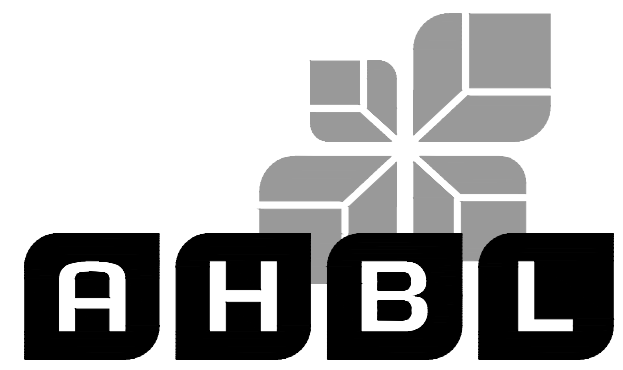

TACOMA · SEATTLE · SPOKANE · TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:

### EAST TOWN CROSSING PHASE 1

Client:  
 ASH DEVELOPMENT


GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:

### PERMIT SUBMITTAL

04/09/2024

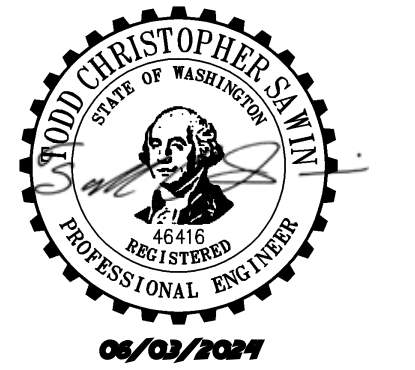

NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT CONSTITUTE A GUARANTEE OR WARRANTY BY THE ENGINEER OR ARCHITECT. THE USER SHALL BE RESPONSIBLE FOR VERIFYING THE ACCURACY OF THE INFORMATION PROVIDED IN THIS DOCUMENT. THE USER SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE APPROPRIATE AGENCIES. THE USER SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY INFORMATION FROM THE PROJECT RECORDS AND THE FIELD. THE USER SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY INFORMATION FROM THE PROJECT RECORDS AND THE FIELD. THE USER SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY INFORMATION FROM THE PROJECT RECORDS AND THE FIELD.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS  
 01/29/24 CITY COMMENTS

Revisions:


### Sheet Title: WATER PROFILES

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI


Sheet No.

# C6.08


49 of 53 Sheets

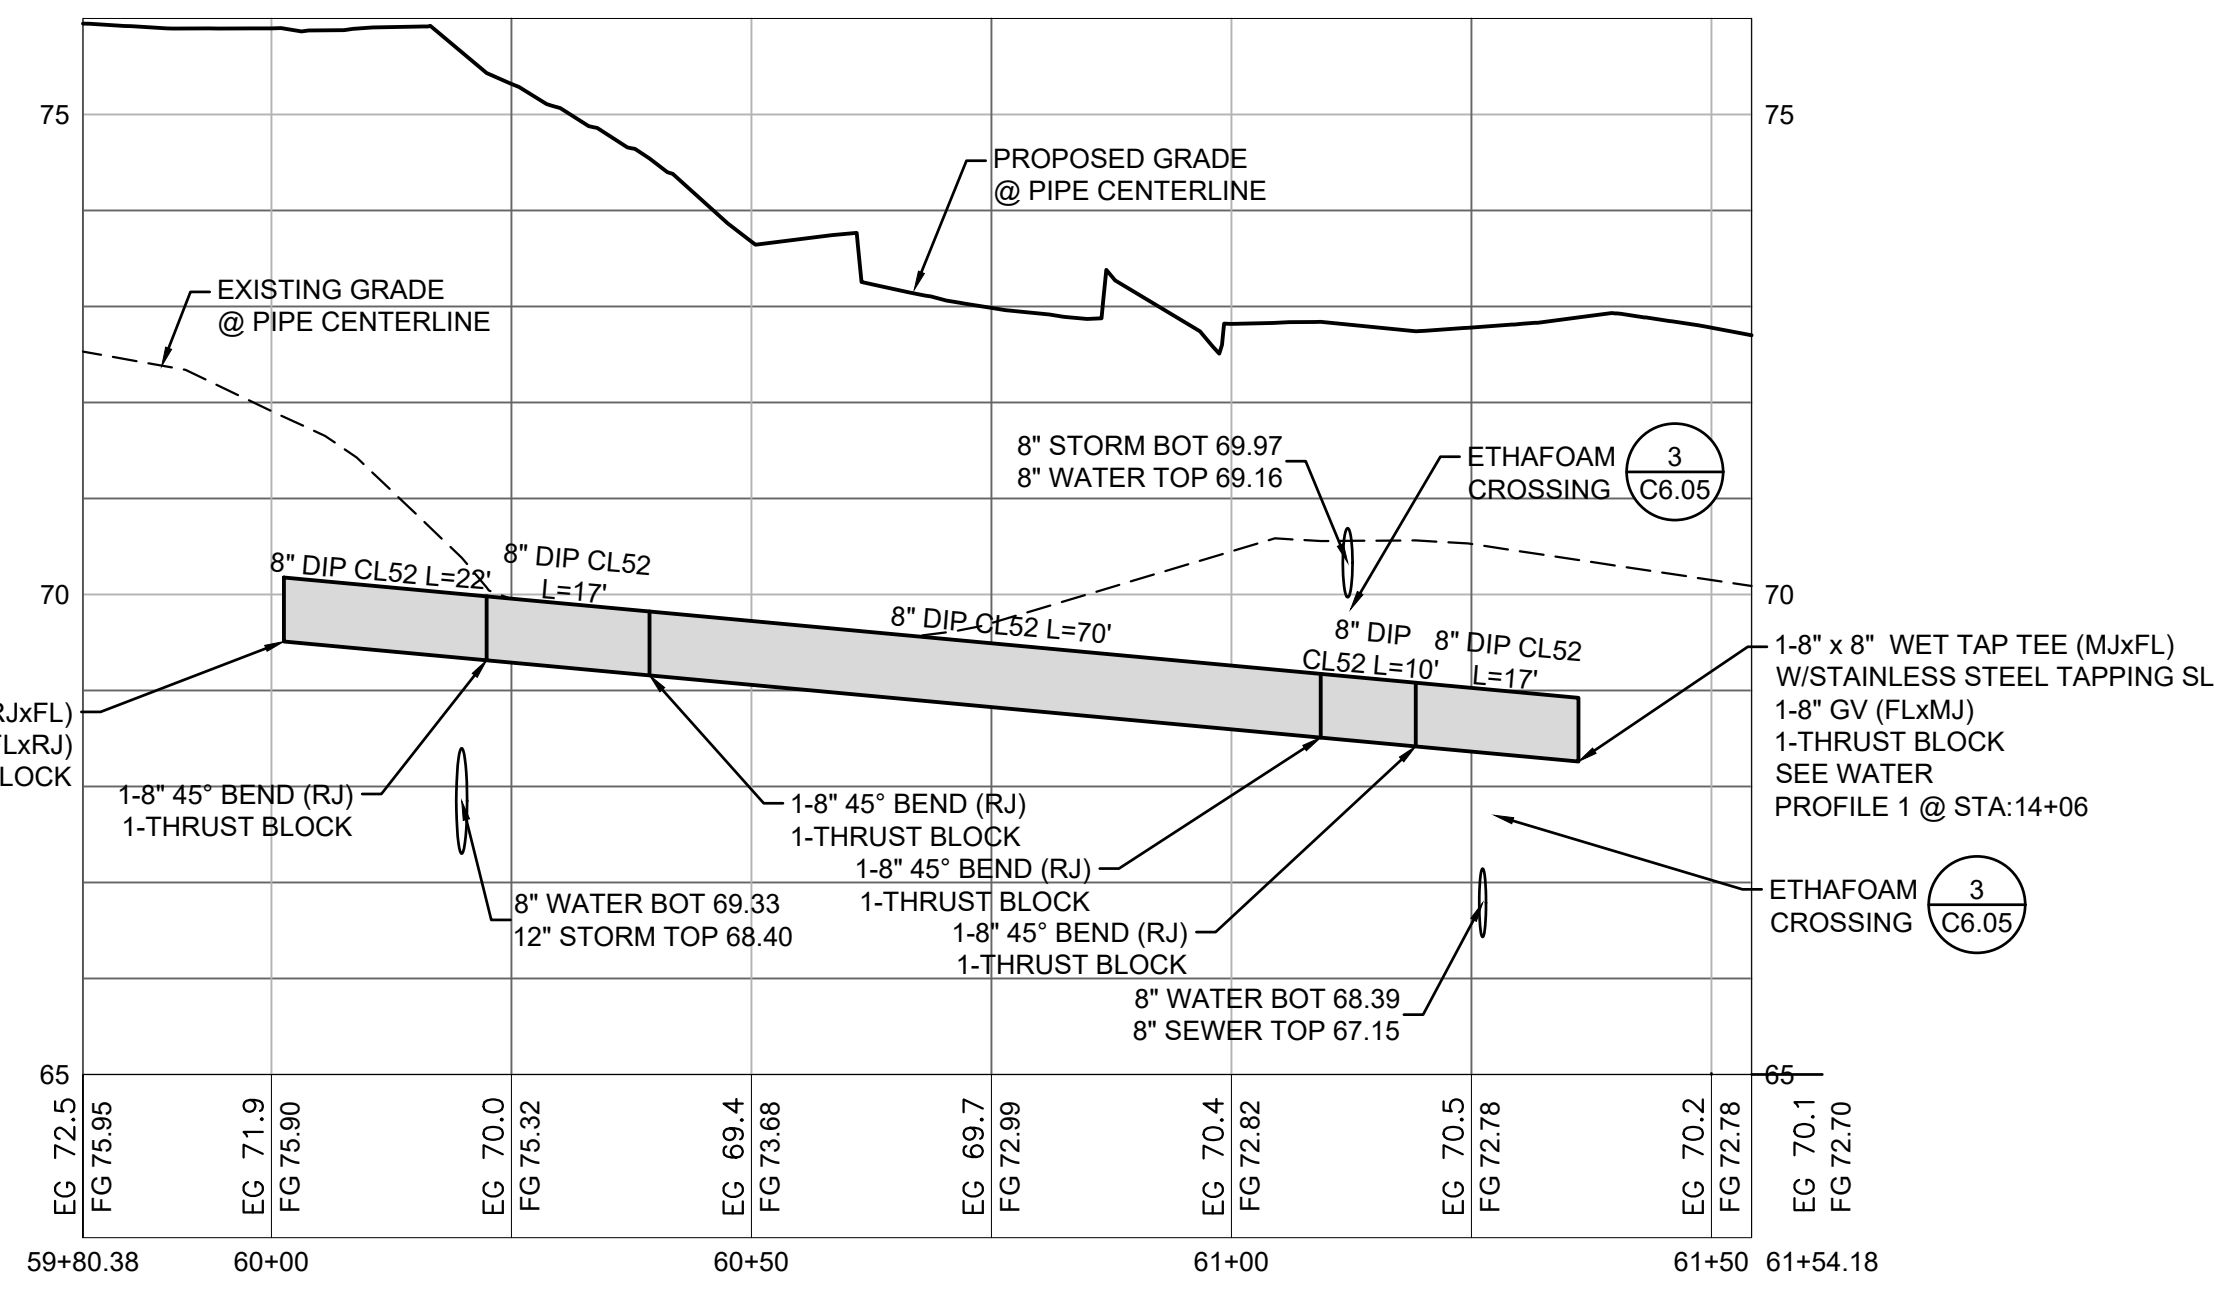


**6 WATER PROFILE 6**  
 1"=2" VERTICAL, 1"=20' HORIZONTAL

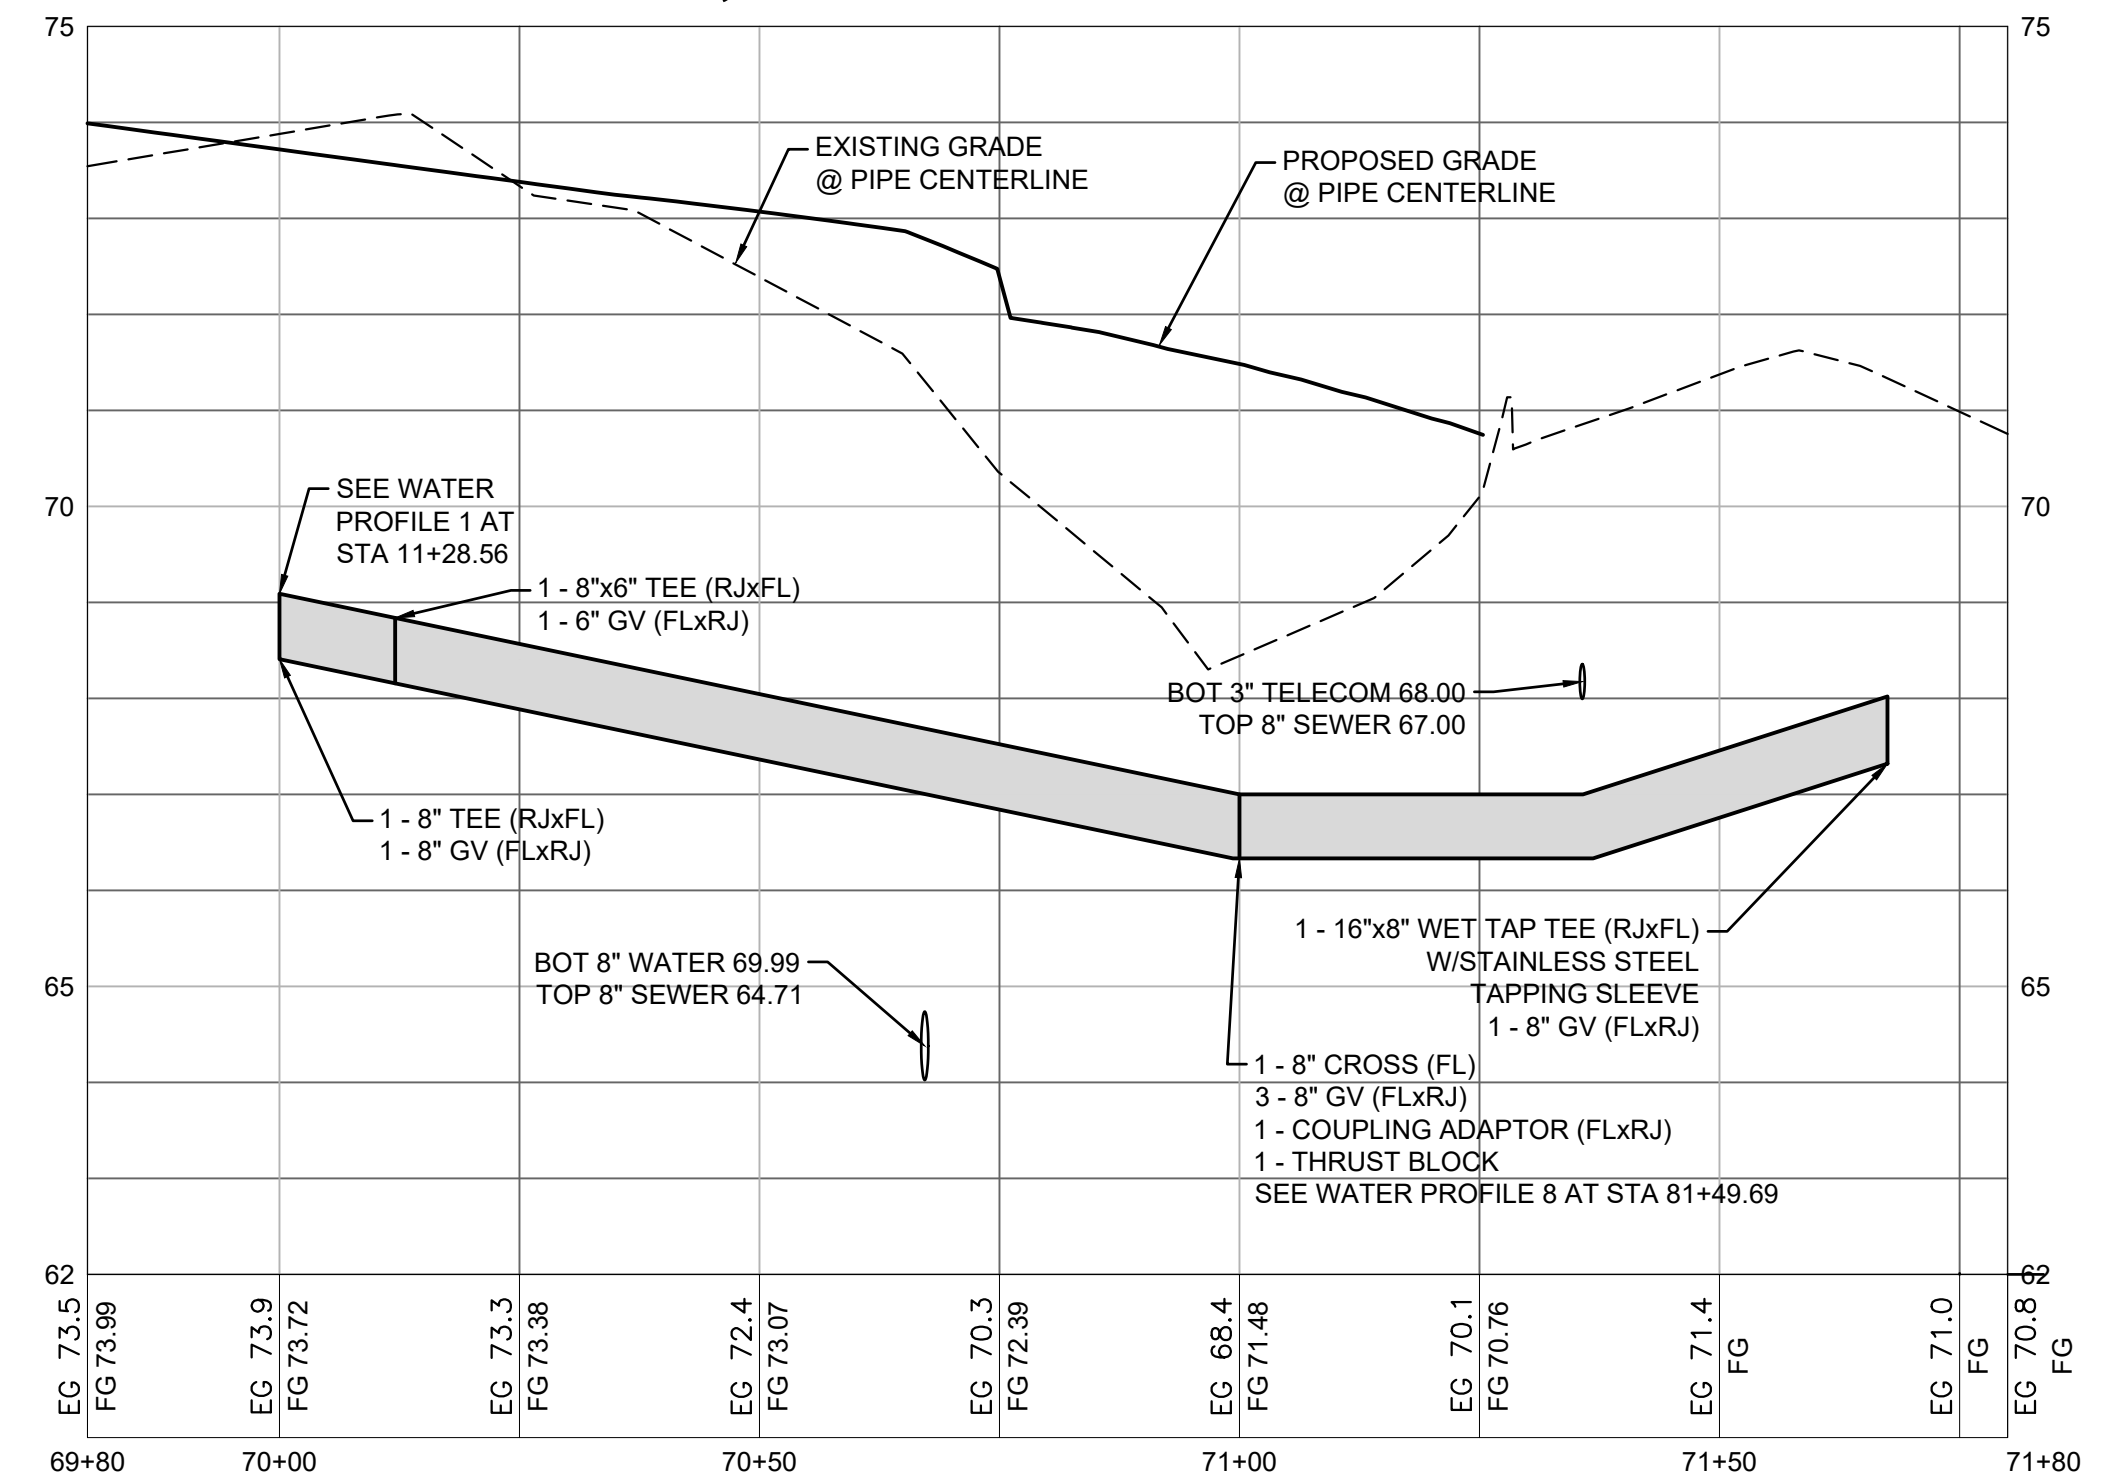


**7 WATER PROFILE 7**  
 NOT TO SCALE

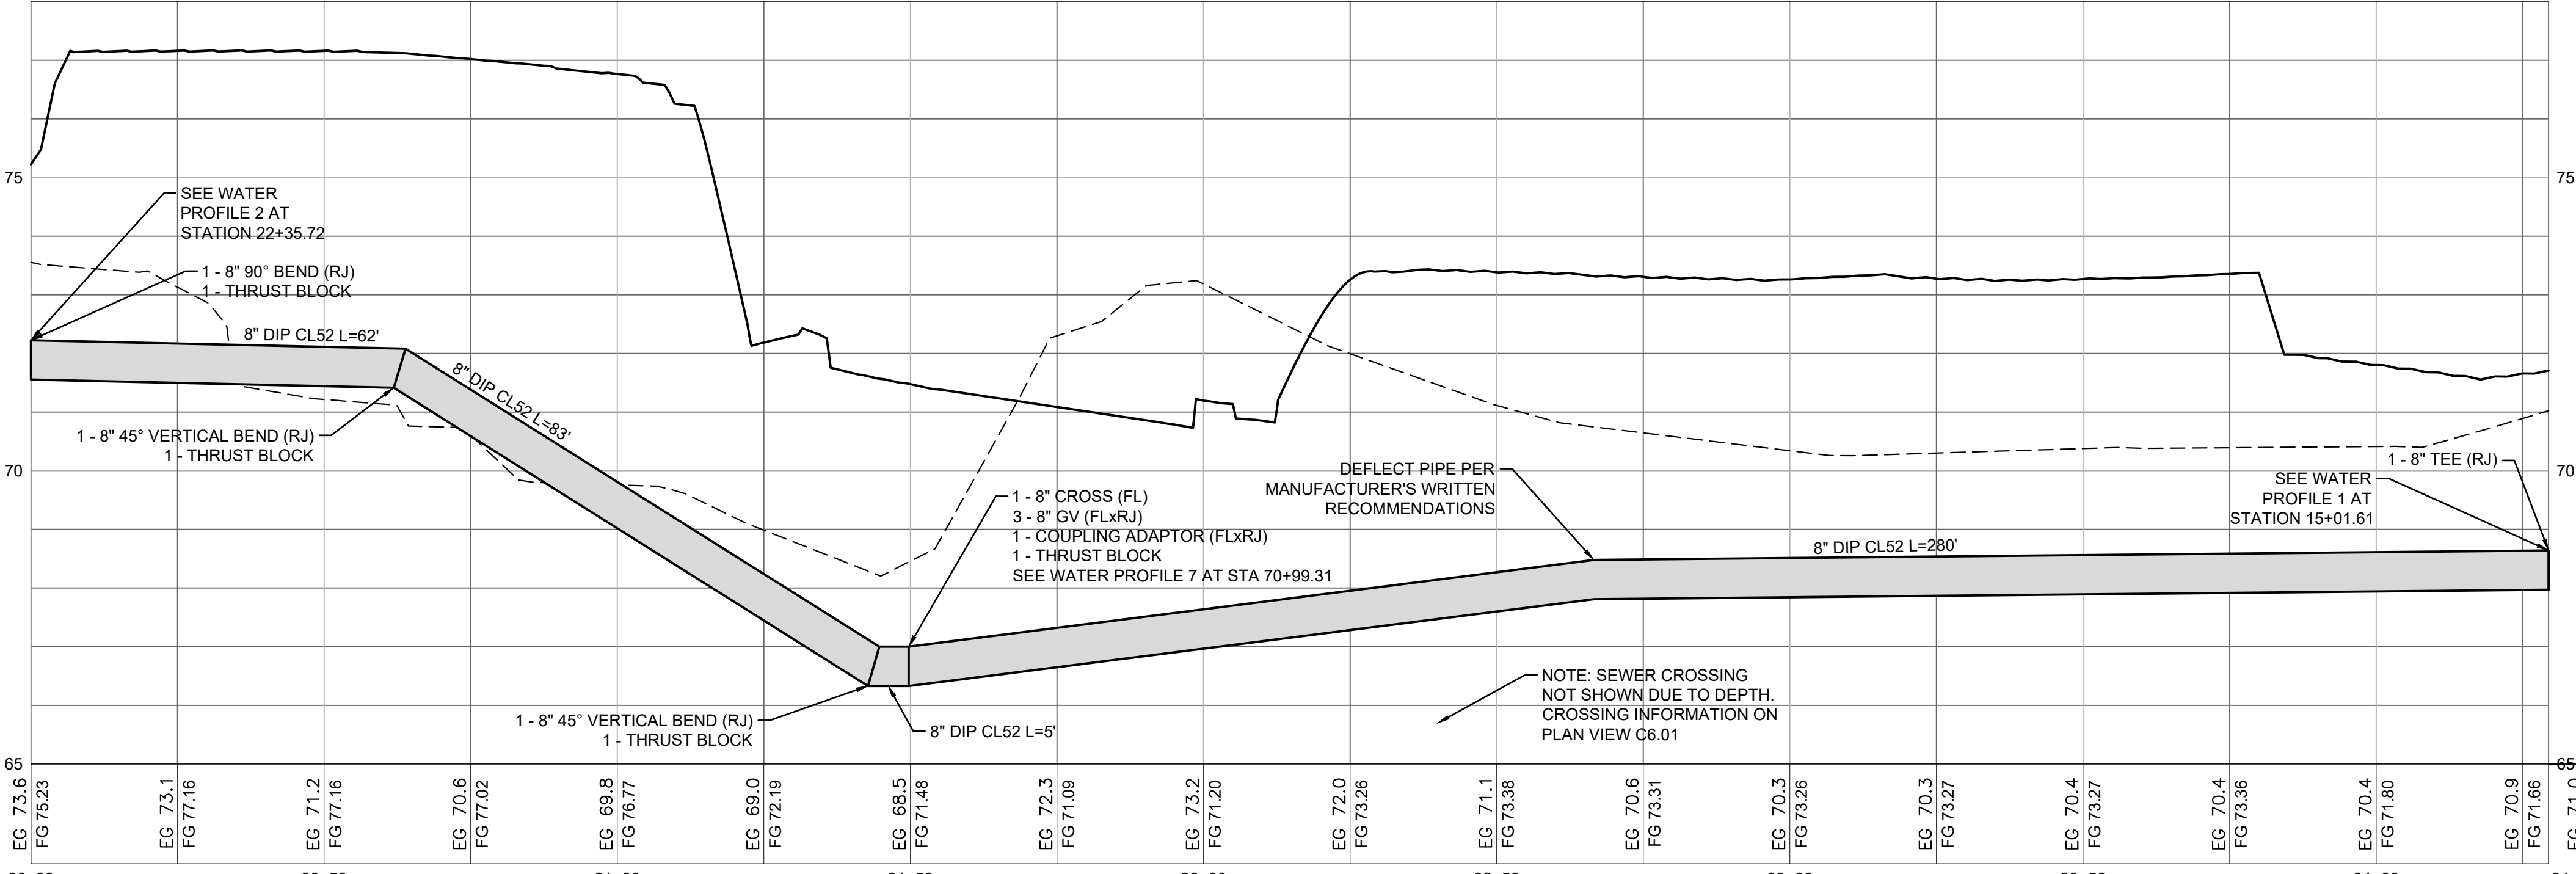


**8 WATER PROFILE 8**  
 1"=2" VERTICAL, 1"=20' HORIZONTAL

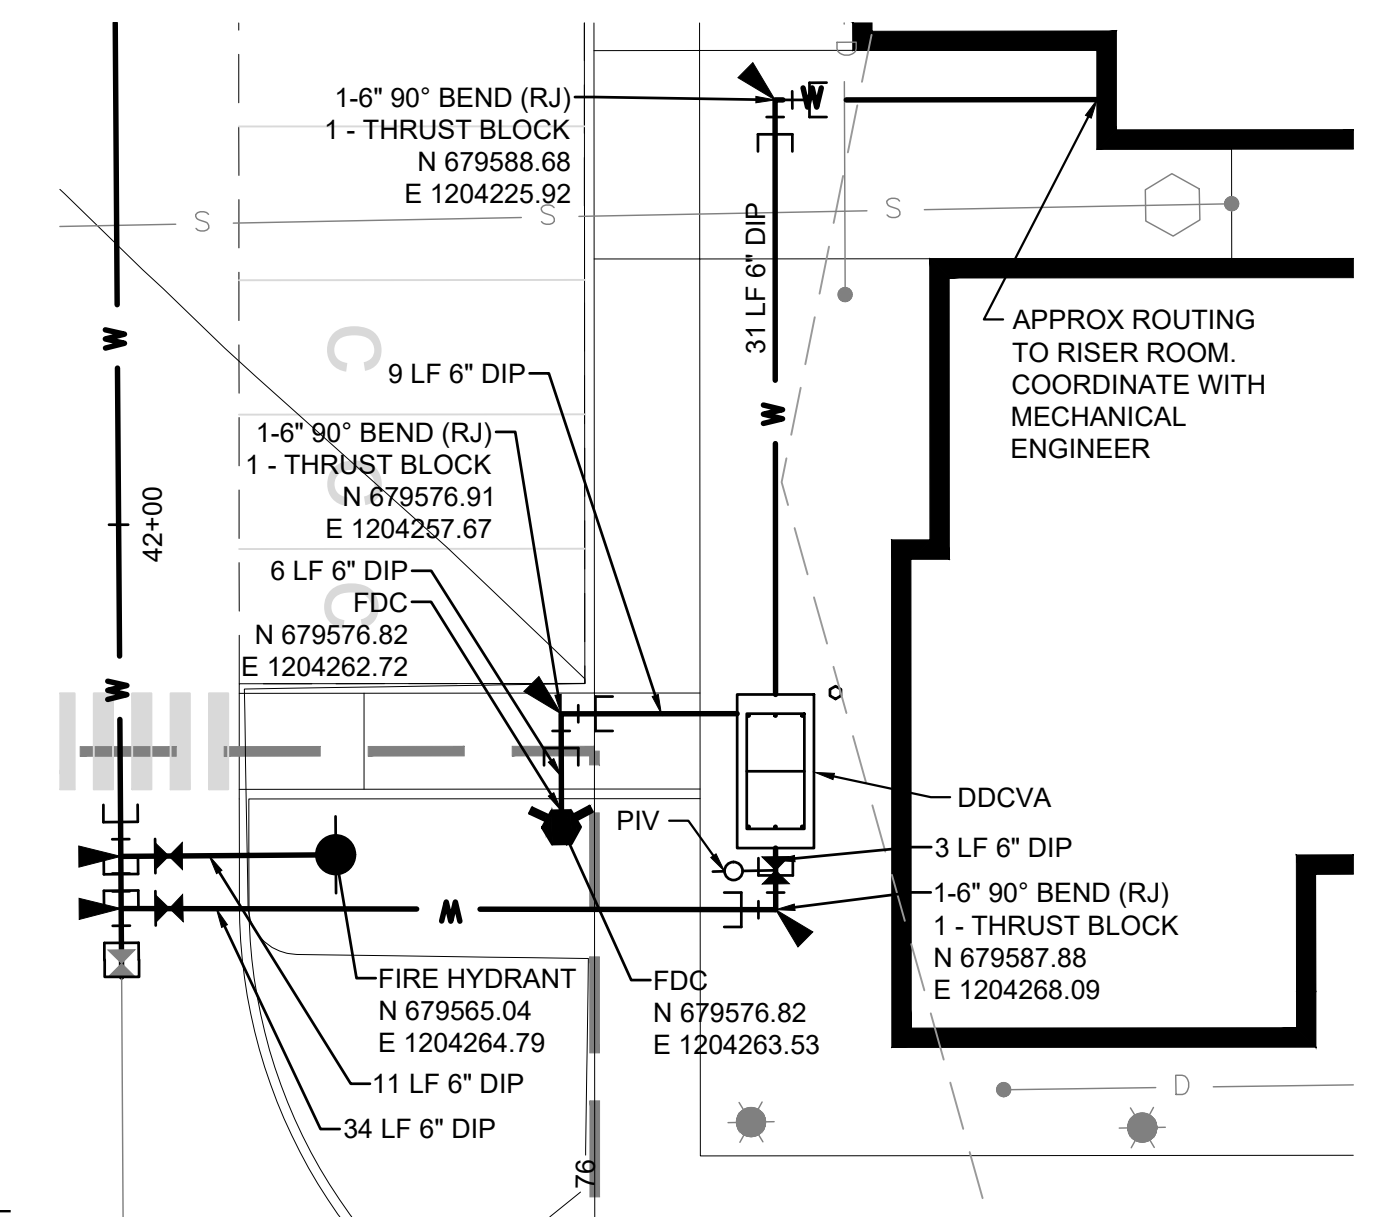

**9 ENLARGEMENT**  
 SCALE: 1"=10'

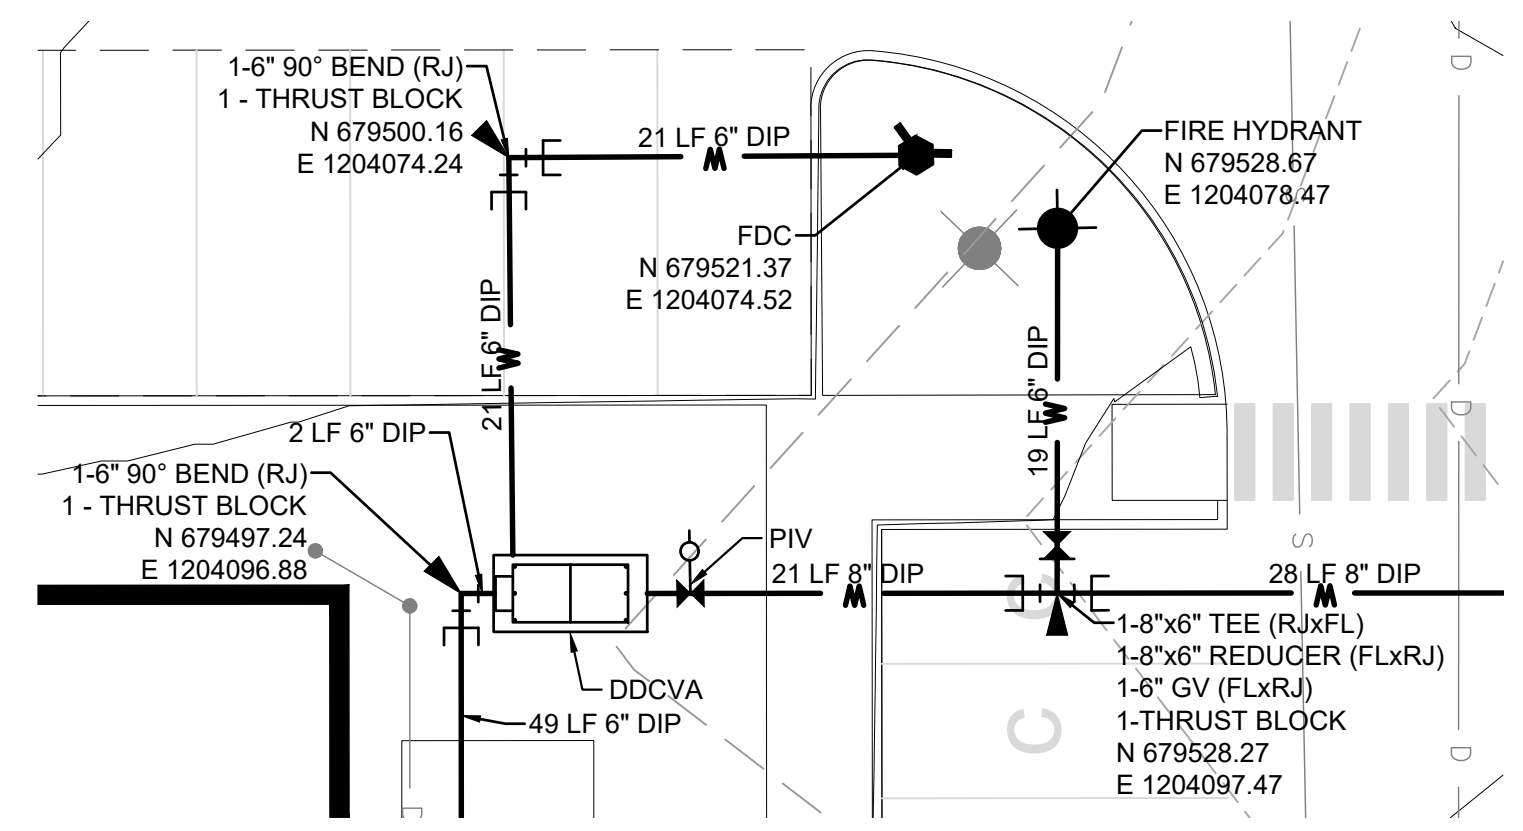

**10 ENLARGEMENT**  
 SCALE: 1"=10'

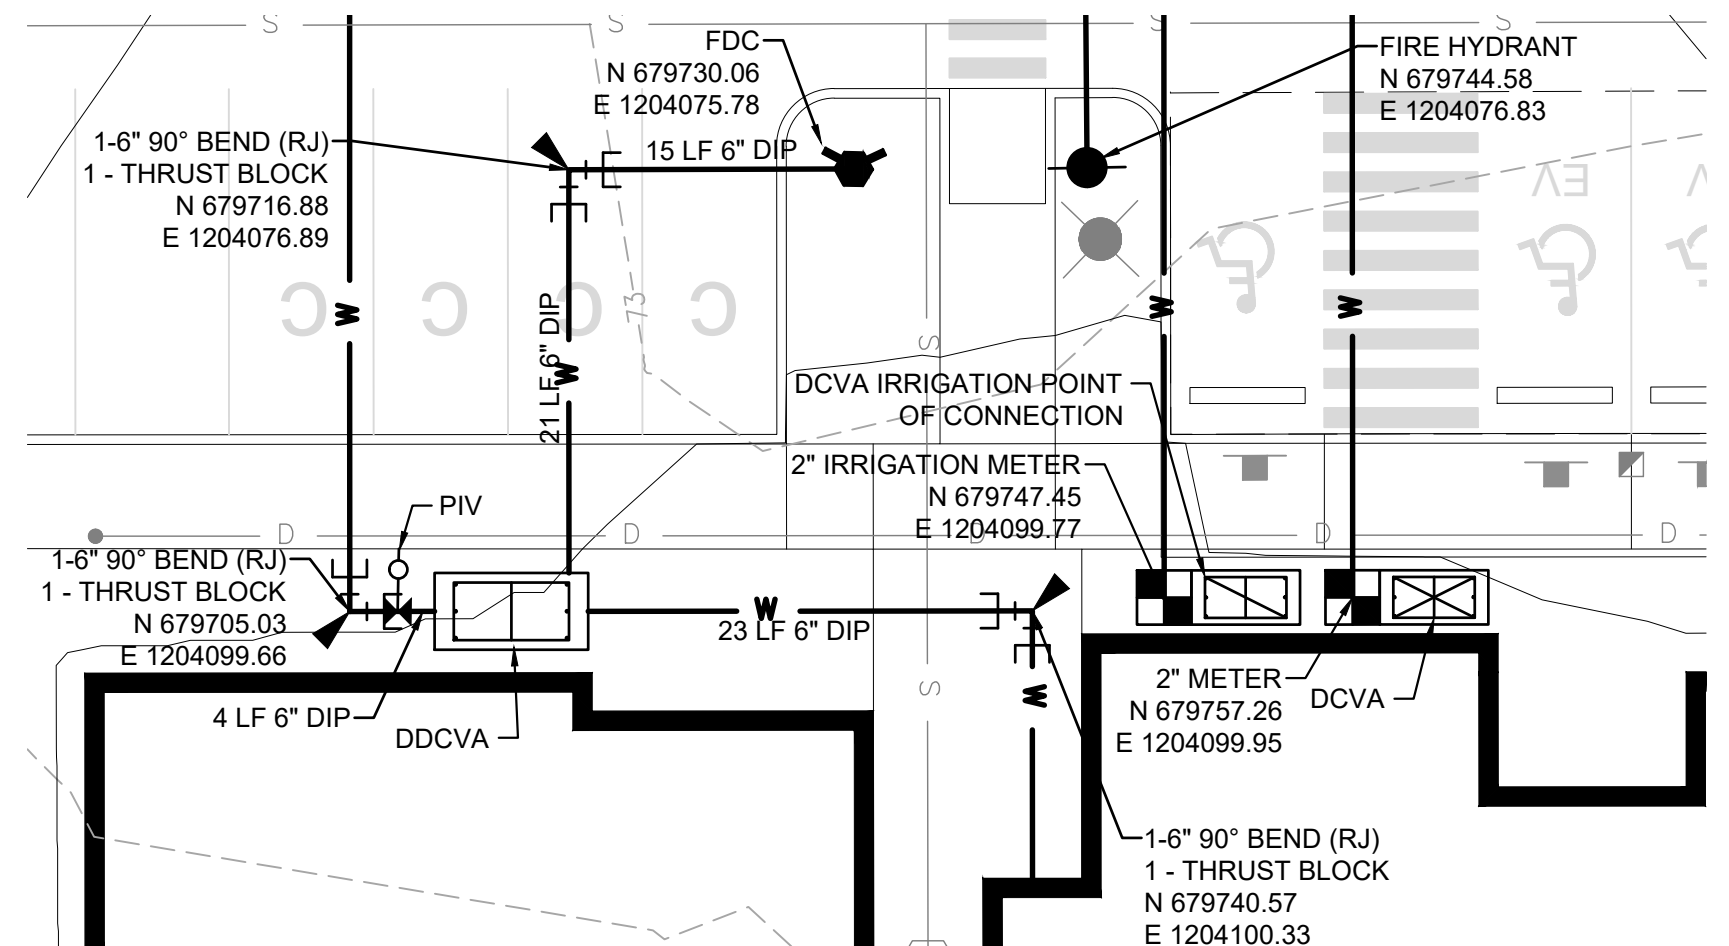

**11 ENLARGEMENT**  
 SCALE: 1"=10'



Know what's below.  
 Call before you dig.




# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

FIRE HYDRANT/FDC LOCATION/ACCESS APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 FIRE CODE OFFICIAL  
 DATE: 06/04/2024

APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

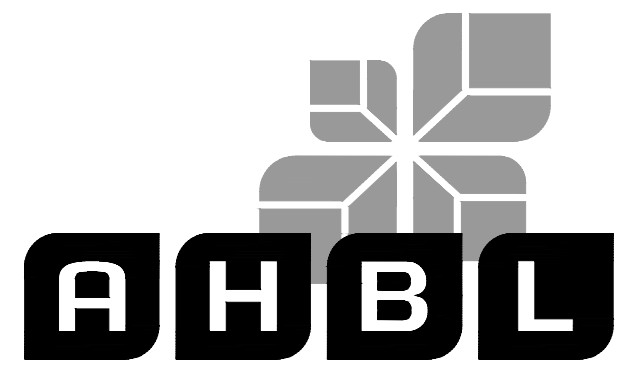

TACOMA • SEATTLE • SPOKANE • TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
**ASH DEVELOPMENT**

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE  
 ALIENATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PURSUANT TO THE REQUIREMENTS OF THE REGISTERED PROFESSIONAL ENGINEER ACT OF THE STATE OF WASHINGTON. THIS DOCUMENT IS NOT TO BE USED FOR ANY OTHER PROJECT.

City of Puyallup Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

NOTE: DRAWINGS DEPICT BLOCK LOCATION, NOT SIZE. FOR SIZE SEE NOTES 3, 4, 5, AND CITY STD. 03.02.01-3

NOTES:  
 1. THE FOLLOWING PRECAUTIONS MUST BE OBSERVED WHEN CONSTRUCTING THRUST BLOCKS:  
 A. BLOCKS MUST BE POURED OR PLACED AGAINST UNDISTURBED SOIL.  
 B. THE PIPE FITTINGS AND BOLTS MUST BE ACCESSIBLE. WRAP IN PLASTIC BEFORE POURING CONCRETE BLOCKING.  
 C. CONCRETE SHOULD BE CURED FOR AT LEAST 5 DAYS AND SHOULD HAVE A MINIMUM COMPRESSION STRENGTH OF 3,000 PSI AT 28 DAYS.  
 D. RESTRAINED JOINTS SHALL BE INSTALLED, IN ADDITION TO CONCRETE THRUST BLOCKING.  
 E. BLOCKS MUST BE POSITIONED TO COUNTERACT THE DIRECTION OF THE RESISTANT THRUST FORCE.  
 2. ALL PIPE SHALL BE PROPERLY BEDDED, SEE CITY OF PUYALLUP STANDARD BEDDING DETAIL NO. 06.01.01.  
 3. CONTRACTOR TO PROVIDE BLOCKING ADEQUATE TO WITHSTAND FULL TEST PRESSURE.  
 4. DRAVE THRUST BY SAFE BEARING LOAD TO DETERMINE REQUIRED AREA (IN SQUARE FEET) OF CONCRETE TO DISTRIBUTE LOAD.  
 5. BEARING SURFACE AREAS TO BE ADJUSTED BY THE ENGINEER FOR OTHER PRESSURE AND/OR SOIL CONDITIONS.

CITY OF PUYALLUP OFFICE OF THE CITY ENGINEER  
 APPROVED FOR PUBLICATION: [Signature]  
 DATE: 03/02/01-1

NOTE: A LENGTH OF 3/8" (MINIMUM - SEE TABLE BELOW) GALVANIZED CHAIN WAPPED TIGHTLY TWO TIMES AROUND FITTING WITH A #4 BARS PLACED THROUGH THE CHAIN ENDS EMERGED INTO THE CONCRETE THRUST BLOCKING.

RESTRAINED JOINTS SHALL BE INSTALLED WITH ALL VERTICAL THRUST BLOCKING.

11-1/4" TO 45° BEND

11-1/4" TO 45° BEND

TABLE 1: CONCRETE BLOCKING FOR VERTICAL BENDS

PIPE DIAMETER (INCHES)	TEST PRESSURE (PSI)	BEND ANGLE (DEGS)	CONCRETE VOLUME (CY)	CURE SIZE (FEET)	CHAIN SIZE (INCHES)	CHAIN EMBEDMENT (INCHES)
4"	200	11.25°	8	1.8	3/8"	17"
		22.5°	12	2.3		
		45°	22	2.8		
6"	200	11.25°	14	2.4	3/8"	17"
		22.5°	27	3.0		
		45°	50	3.7		
8"	200	11.25°	26	2.9	3/8"	17"
		22.5°	48	3.8		
		45°	89	4.5		
10"	200	11.25°	38	3.4	3/8"	17"
		22.5°	75	4.2		
		45°	139	5.2		
12"	200	11.25°	55	3.8	3/8"	17"
		22.5°	108	4.8		
		45°	200	5.8		
14"	200	11.25°	75	4.2	3/8"	17"
		22.5°	147	5.3		
		45°	272	6.5		
16"	200	11.25°	98	4.8	3/8"	17"
		22.5°	192	5.8		
		45°	355	7.1		

NOTE: ALL NOTES ON CITY STANDARD 03.02.01-1 SHALL APPLY TO THIS DETAIL. SEE CITY STANDARD 03.02.01-3 FOR ADDITIONAL INFORMATION.

CITY OF PUYALLUP OFFICE OF THE CITY ENGINEER  
 APPROVED FOR PUBLICATION: [Signature]  
 DATE: 03/02.01-2

TABLE 2: THRUST AT FITTINGS AT 200 PSI

SIZE	TEST PRESSURE (PSI)	THRUST FITTINGS AT 200 PSI				
		A	B	C	D	E
4"	200	3,145	4,140	4,440	2,403	2,225
6"	200	7,070	9,885	5,410	3,760	1,385
8"	200	12,665	17,770	8,820	4,905	2,465
10"	200	18,835	27,770	15,030	7,860	3,850
12"	200	28,875	38,885	21,840	11,030	5,545
14"	200	38,485	54,425	28,455	15,015	7,545
16"	200	50,285	71,285	38,470	19,815	9,855

TABLE 3: BEARING VALUE OF SOIL

SOIL TYPE	SAFE BEARING LOAD LB/SQ FT
MUCK PEAT, ETC.	0
SOFT CLAY/ALLUVIAL SOIL	1,000
SAND	2,000
SAND AND GRAVEL	3,000
SAND AND GRAVEL CEMENTED WITH CLAY	4,000
HARD SHALE	10,000

SEE CITY STANDARDS 03.02.01-1 AND 03.02.01-2 FOR ADDITIONAL INFORMATION.

NOTES:  
 1. TO DETERMINE THRUST AT PRESSURES OTHER THAN 200 PSI, MULTIPLY THE THRUST OBTAINED IN TABLE 2 BY THE RATIO OF THE PRESSURE TO 200 PSI.  
 EXAMPLE: THE THRUST ON A 12 INCH, 90° BEND AT 300 PSI:  
 $38,885 \times \frac{300}{200} = 58,328$  LBS  
 2. TO DETERMINE THE BEARING AREA OF THE THRUST BLOCK IN SQUARE FEET (SF), SEE TABLE 3, BEARING VALUE OF SOIL.  
 EXAMPLE: FOR SAND AND GRAVEL, BEARING VALUE FROM TABLE 3 IS 3,000 LB/SQ FT.  
 $58,328 \text{ LBS} \div 3,000 \text{ LB/SQ FT} = 19.44$  SF OF AREA.  
 3. CONTRIBUTE TO PROVIDE BLOCKING ADEQUATE TO WITHSTAND FULL TEST PRESSURE.  
 4. AREAS SHALL BE ADJUSTED FOR OTHER PRESSURE CONDITIONS.  
 5. NO WATER MAIN SHALL DEAD END AGAINST A MAIN LINE VALVE. DEAD END WATER MAINS SHALL BE BLOCKED AGAINST A RESTRAINED MECHANICAL JOINT (M.A.) PLUG OR CAP.

CITY OF PUYALLUP OFFICE OF THE CITY ENGINEER  
 APPROVED FOR PUBLICATION: [Signature]  
 DATE: 03/02.01-3

NOTES:  
 1. FOR SINGLE FAMILY RESIDENTIAL CONSTRUCTION, THE CITY SHALL SUPPLY AND INSTALL THE WATER METER AND TRANSMITTER AT THE TIME OF OCCUPANCY. FOR COMMERCIAL CONSTRUCTION THE CONTRACTOR SHALL SUPPLY AND INSTALL THE WATER METER AND TRANSMITTER.  
 2. ALL MATERIALS AND FITTINGS SHALL BE AS SPECIFIED OR AN APPROVED EQUAL.  
 3. NORMALLY THE WATER METER BOX SHOULD BE LOCATED IN THE PLANTING STRIP. IF SPACING IS AGAINST THE CURB, PLACE METER BOX DIRECTLY BEHIND THE SIDEWALK.  
 4. THE WATER METER BOX SHALL NOT BE LOCATED IN HAND SPACES, SIDEWALKS, UNPAVED AREAS, OR AREAS OF HIGH TRAFFIC OR OF ALL OTHERS SHALL USE PIPE NEAREST FITTINGS.  
 5. THE WATER SERVICE LINE SHALL BE BEDDED IN WASHED SAND WITH 3/4\"/>

CITY OF PUYALLUP OFFICE OF THE CITY ENGINEER  
 APPROVED FOR PUBLICATION: [Signature]  
 DATE: 03.03.01

1 HORIZONTAL THRUST BLOCKING  
 NOT TO SCALE

2 VERTICAL THRUST BLOCKING  
 NOT TO SCALE

3 THRUST BLOCKING TABLE  
 NOT TO SCALE

4 0.75IN OR 1IN WATER SERVICE CONNECTION  
 NOT TO SCALE

NOTES:  
 1. ALL MATERIALS AND FITTINGS SHALL BE AS SPECIFIED OR AN APPROVED EQUAL.  
 2. WATER MAINS SHALL HAVE A MINIMUM COVER OF 36\"/>

CITY OF PUYALLUP OFFICE OF THE CITY ENGINEER  
 APPROVED FOR PUBLICATION: [Signature]  
 DATE: 03.03.02

5 1.5IN OR 2IN WATER SERVICE CONNECTION  
 NOT TO SCALE

NOTES:  
 1. SERVICE LINE MAY BE 200 PSI POLY PIPE IN UNCONTAMINATED SOILS. IN SOILS THAT MAY CONTAIN HYDROCARBONS USE 1\"/>

CITY OF PUYALLUP OFFICE OF THE CITY ENGINEER  
 APPROVED FOR PUBLICATION: [Signature]  
 DATE: 03.03.04

6 PRIVATE WATER SERVICE LINES  
 NOT TO SCALE

NOTES:  
 1. BACKFLOW ASSEMBLY MUST BE SELECTED FROM WASHINGTON STATE DEPARTMENT OF HEALTH'S LIST OF BACKFLOW PREVENTION ASSEMBLIES APPROVED FOR INSTALLATION IN WASHINGTON STATE, LATEST EDITION.  
 2. THE DOA SHALL BE INSTALLED WITH ADEQUATE SPACE TO FACILITATE MAINTENANCE AND TESTING. IT SHALL BE TESTED AFTER INSTALLATION, BY A WASHINGTON STATE CERTIFIED BACKFLOW ASSEMBLY TESTER, TO INSURE ITS SATISFACTORY OPERATION BEFORE OCCUPANCY, AND ANNUALLY THEREAFTER. SEND TEST RESULTS TO CITY OF PUYALLUP, WATER QUALITY OPERATIONS, 1100 JOHN AVE. SE, PUYALLUP, WA 98404.  
 3. DOA MUST BE PURCHASED AS A LINE, NO ADJUSTMENTS TO THE ASSEMBLY ARE ALLOWED.  
 4. DOA SHALL BE PLACED IMMEDIATELY DOWNSTREAM OF WATER MAIN. WHEN IRIGATION SYSTEM IS CONNECTED OFF DOMESTIC WATER LINE, THE IRIGATION DOA SHALL BE PLACED IMMEDIATELY DOWNSTREAM OF THE IRIGATION SYSTEM.  
 5. DOA SHALL BE SEED EQUAL OR COMPARABLE TO WATER SIZE.  
 6. METER BOX SHALL BE LARGE ENOUGH TO ALLOW THE MINIMUM NETWORK ILLUSTRATED ABOVE. METER BOX LD SHALL BE A TYPICAL LD WITH A 1/2\"/>

CITY OF PUYALLUP OFFICE OF THE CITY ENGINEER  
 APPROVED FOR PUBLICATION: [Signature]  
 DATE: 03.04.01

7 2 IN AND SMALLER DCVA INSTALLATION  
 NOT TO SCALE

NOTES:  
 1. ALL MATERIALS AND FITTINGS SHALL BE AS SPECIFIED OR APPROVED EQUAL.  
 2. WATER MAINS SHALL HAVE A MINIMUM COVER OF 36\"/>

CITY OF PUYALLUP OFFICE OF THE CITY ENGINEER  
 APPROVED FOR PUBLICATION: [Signature]  
 DATE: 03.05.01

8 FIRE HYDRANT ASSEMBLY  
 NOT TO SCALE



Know what's below.  
 Call before you dig.




# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

FIRE HYDRANT/FDC LOCATION/ACCESS APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 FIRE CODE OFFICIAL  
 DATE: 06/04/2024

APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

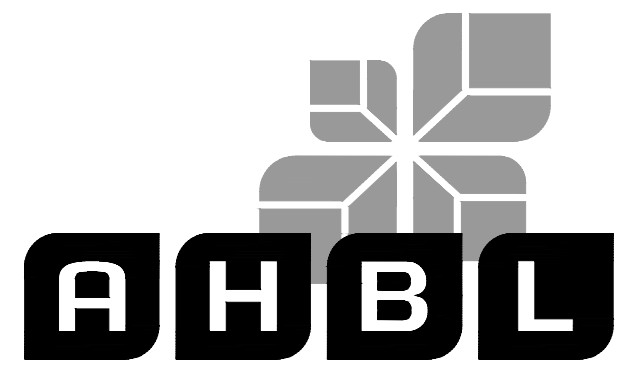

TACOMA • SEATTLE • SPOKANE • TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT  
 GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752  
 Issue Set & Date:  
 PERMIT SUBMITTAL  
 05/17/2024



NOTICE  
 ALTERATION OF THIS DOCUMENT SHALL INVALIDATE THE PROFESSIONAL SEAL AND SIGNATURE. PUBLICATION OF THIS DOCUMENT DOES NOT GUARANTEE FROM NEGLIGENCE OR OTHER PROFESSIONAL LIABILITY. THE DRAWING IS TO BE USED ONLY FOR THE PROJECT EXPLICITLY IDENTIFIED IN THE TITLE BLOCK AND IS NOT TO BE USED FOR OTHER PROJECTS OR ADDITION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**


Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS  
 01/29/24 CITY COMMENTS  
 Revisions:


Sheet Title:  
**WATER NOTES AND DETAILS**

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI


Sheet No.  
**C6.10**  
 51 of 53 Sheets

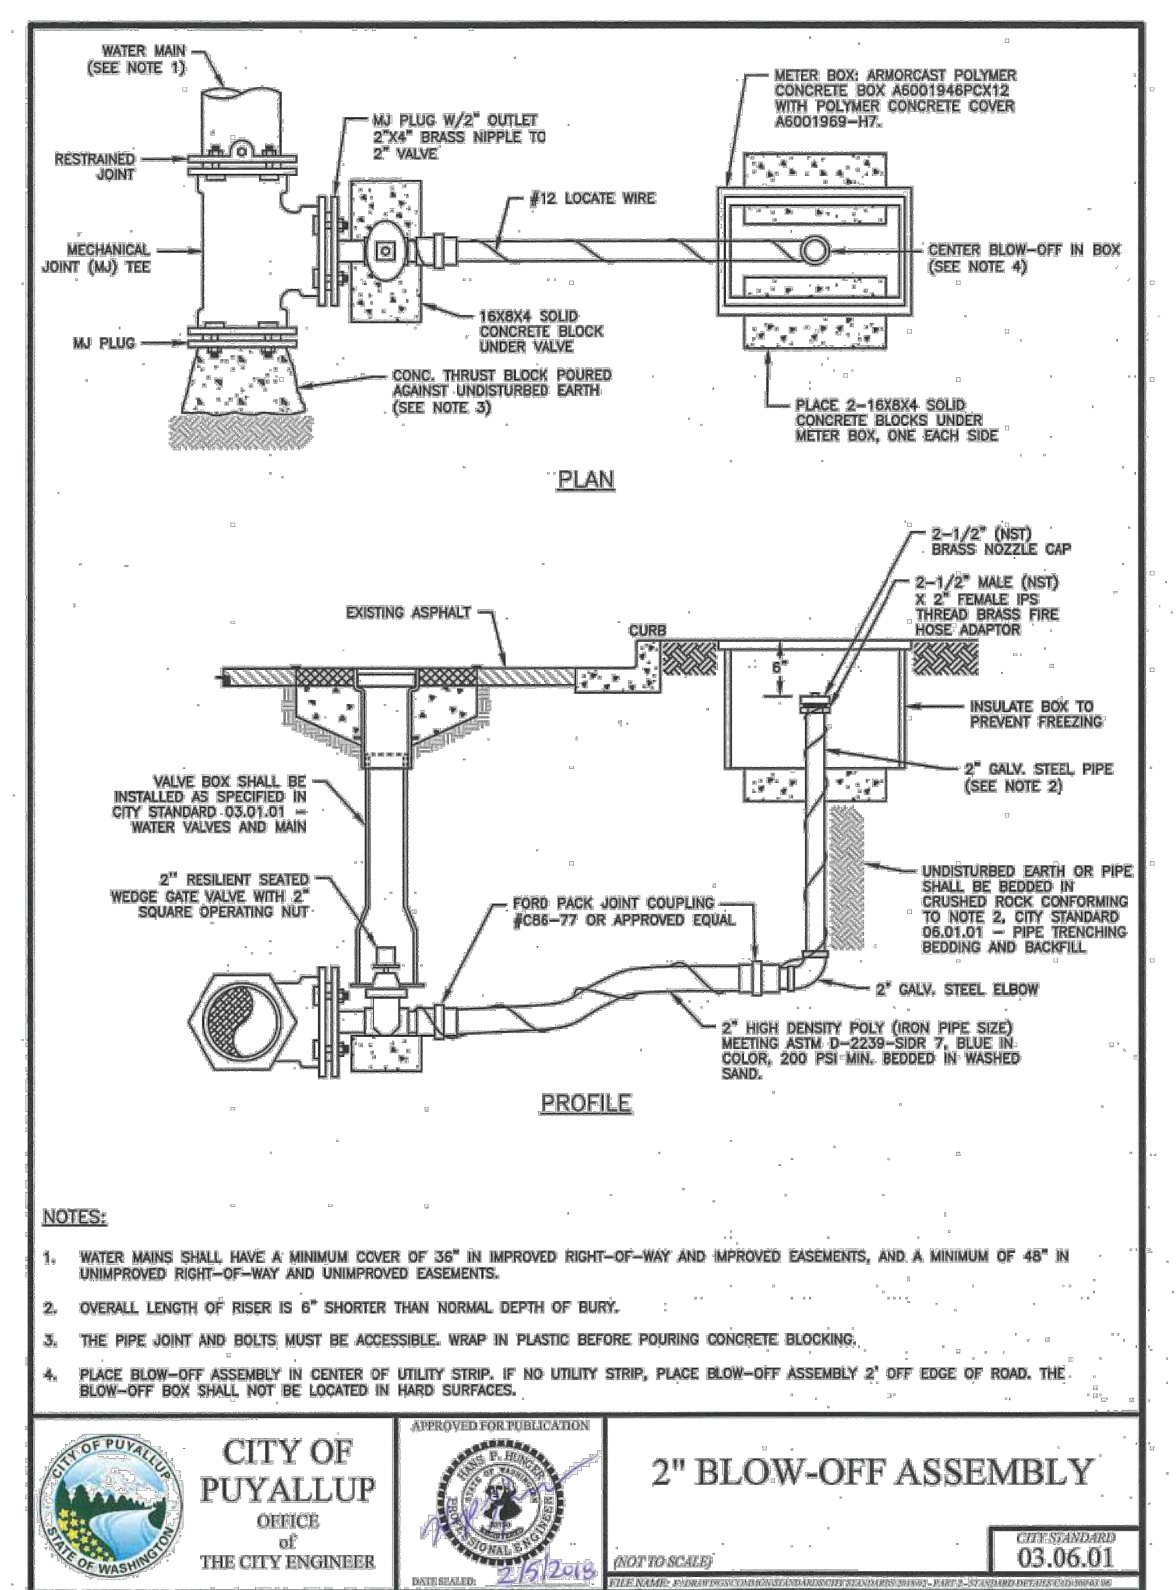


**1 2 IN BLOW-OFF ASSEMBLY**  
 NOT TO SCALE

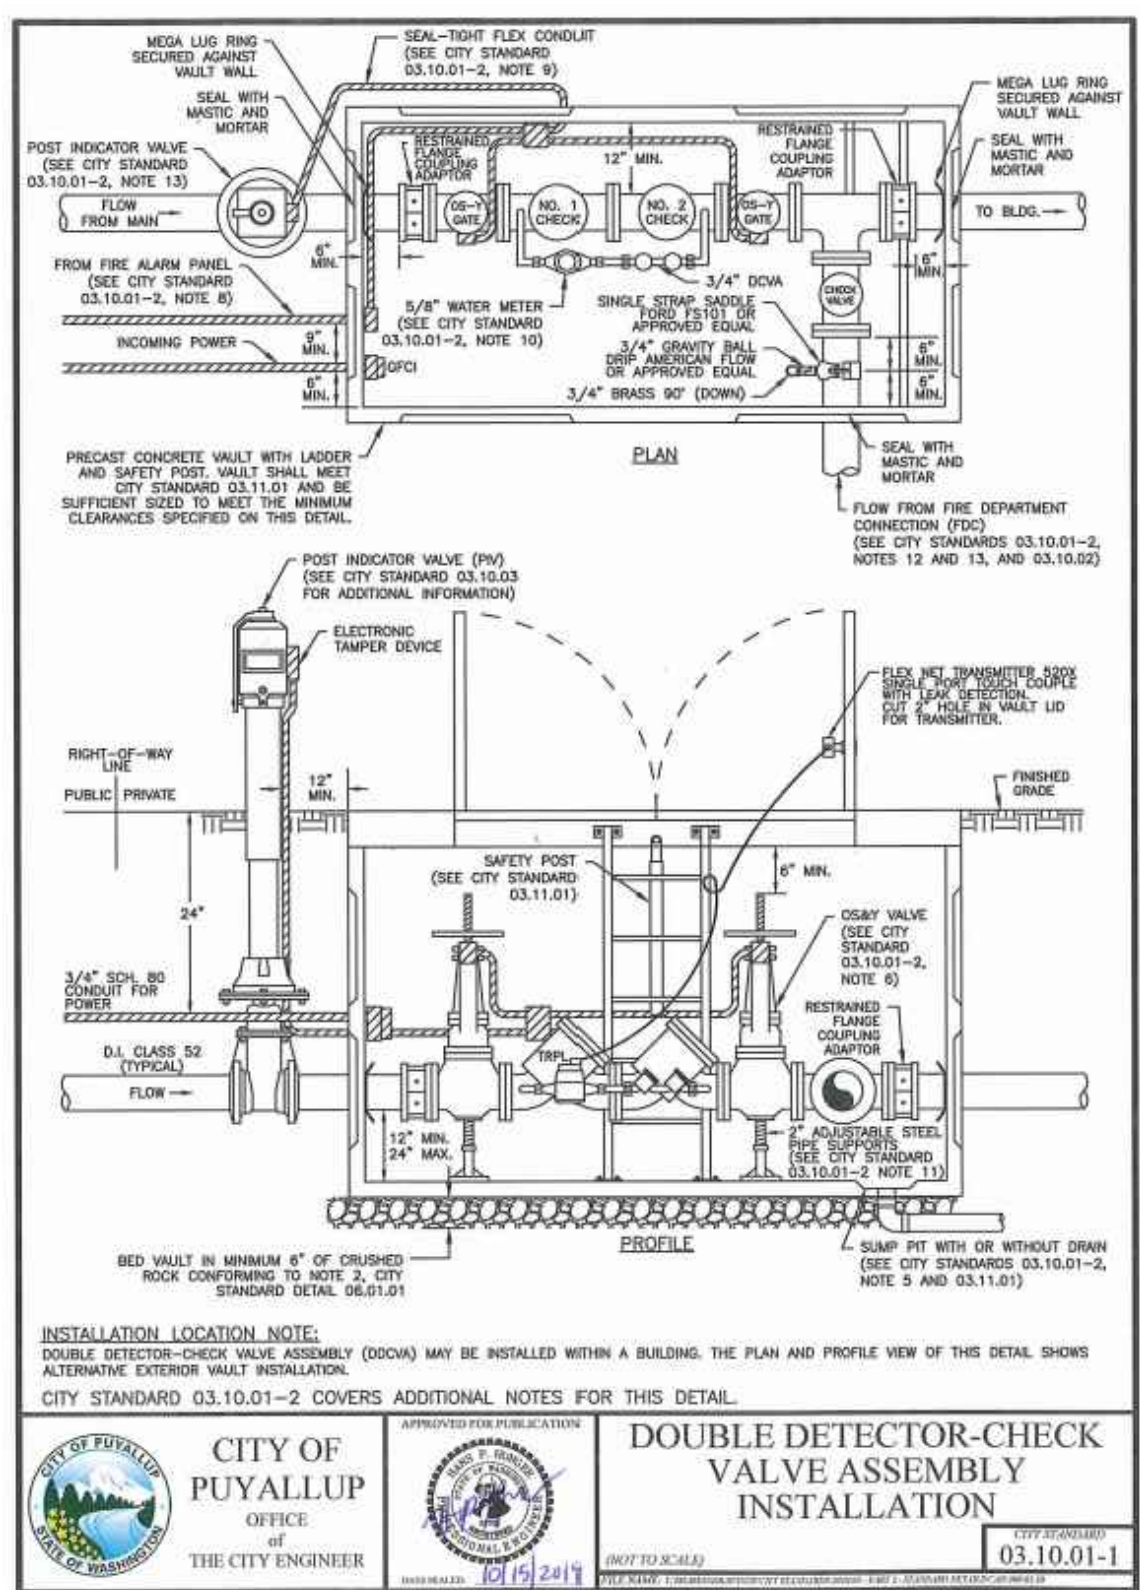


**2 DOUBLE DETECTOR CHECK VALVE ASSEMBLY INSTALLATION**  
 NOT TO SCALE

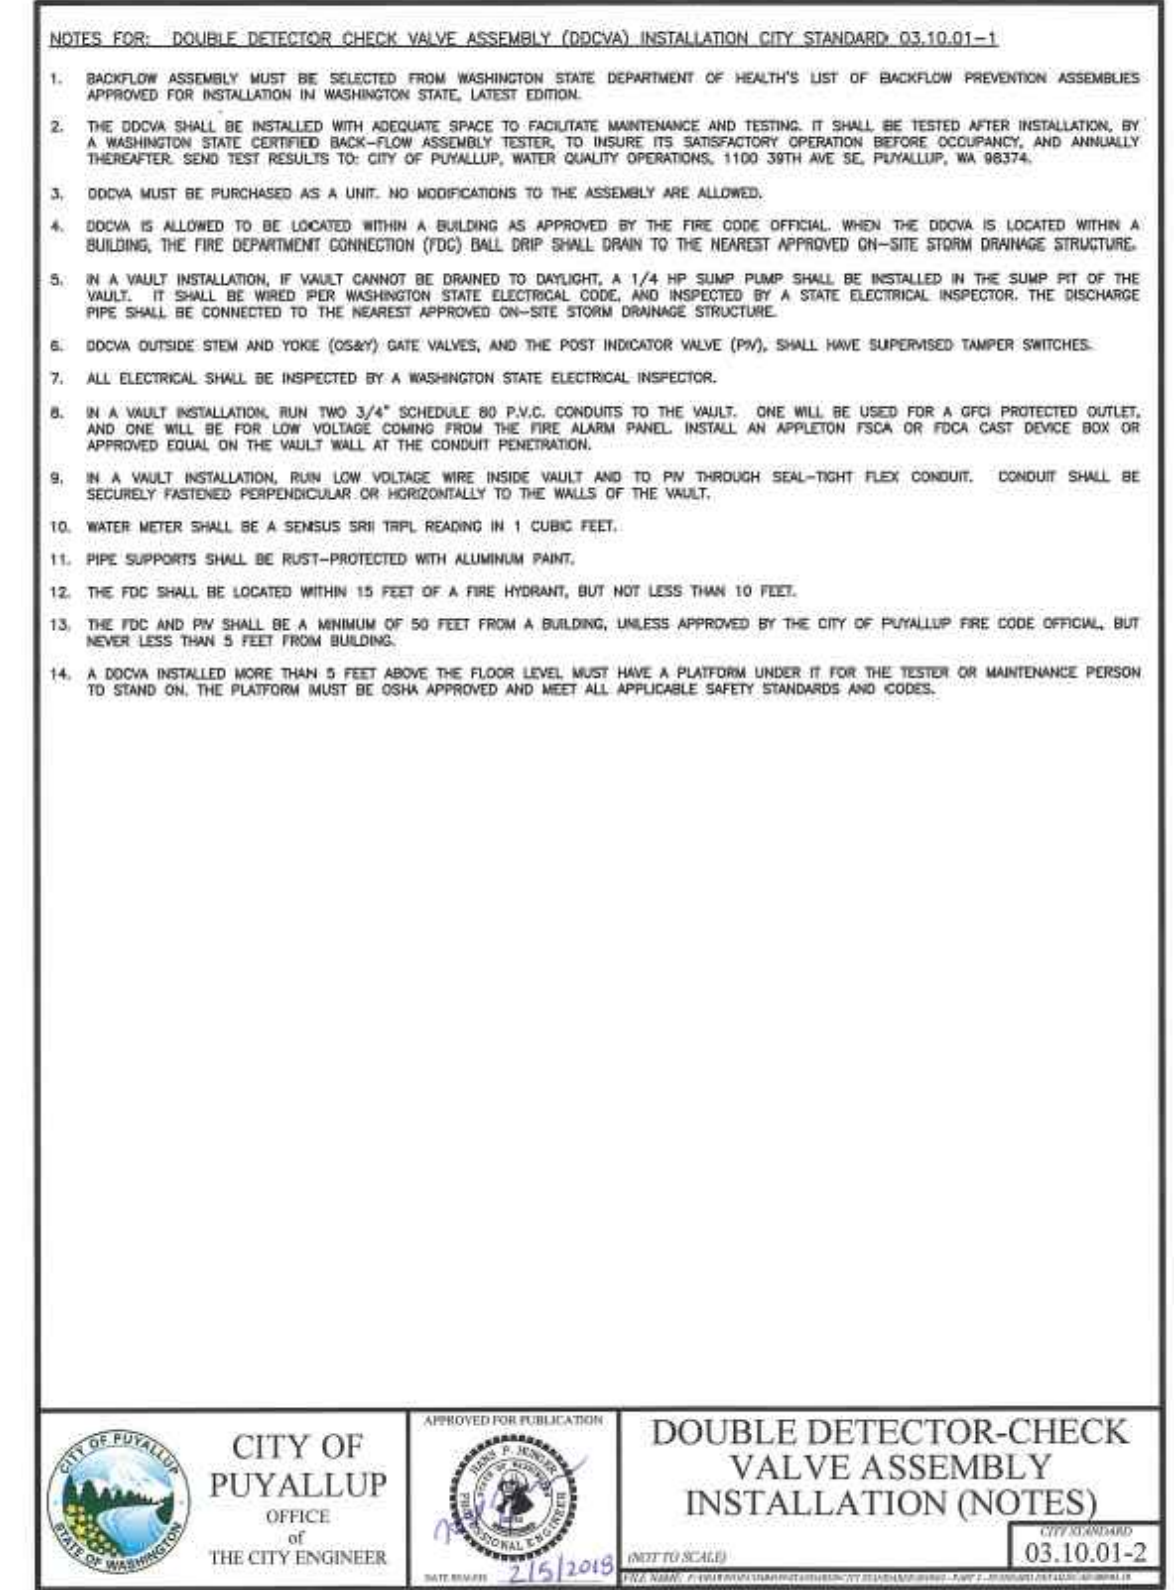

**3 DOUBLE DETECTOR CHECK VALVE ASSEMBLY INSTALLATION (NOTES)**  
 NOT TO SCALE

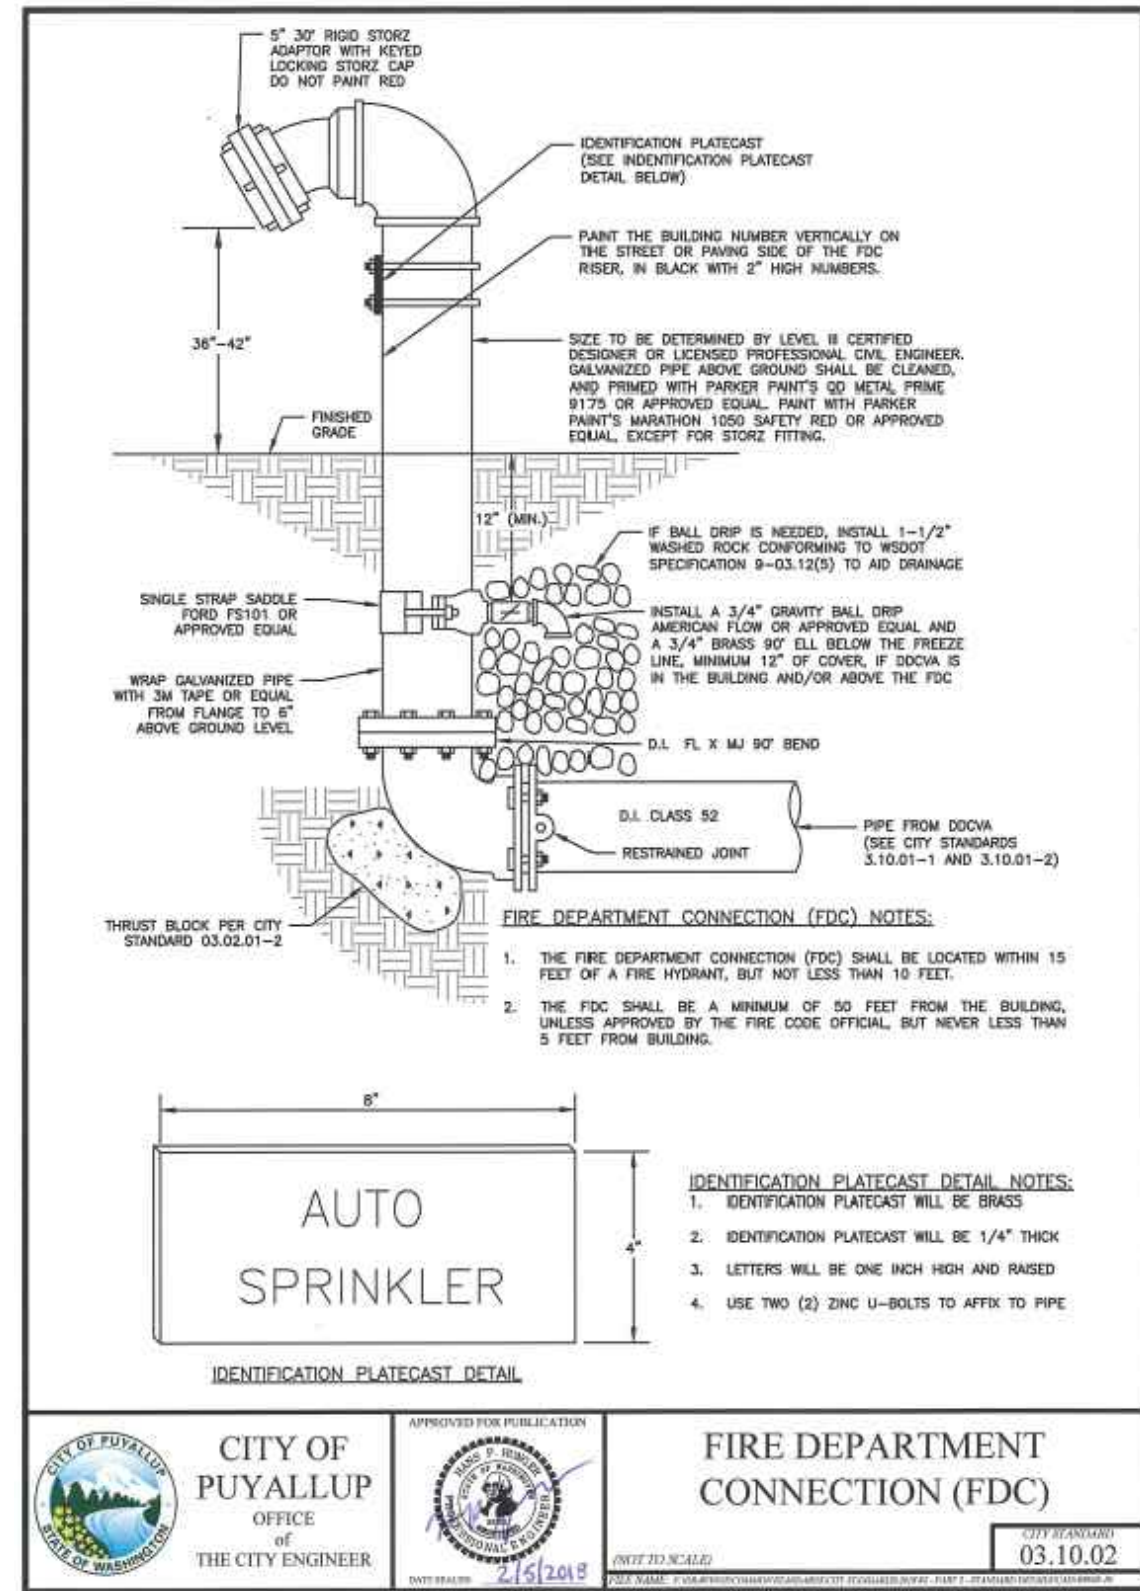

**4 FIRE DEPARTMENT CONNECTION (FDC)**  
 NOT TO SCALE

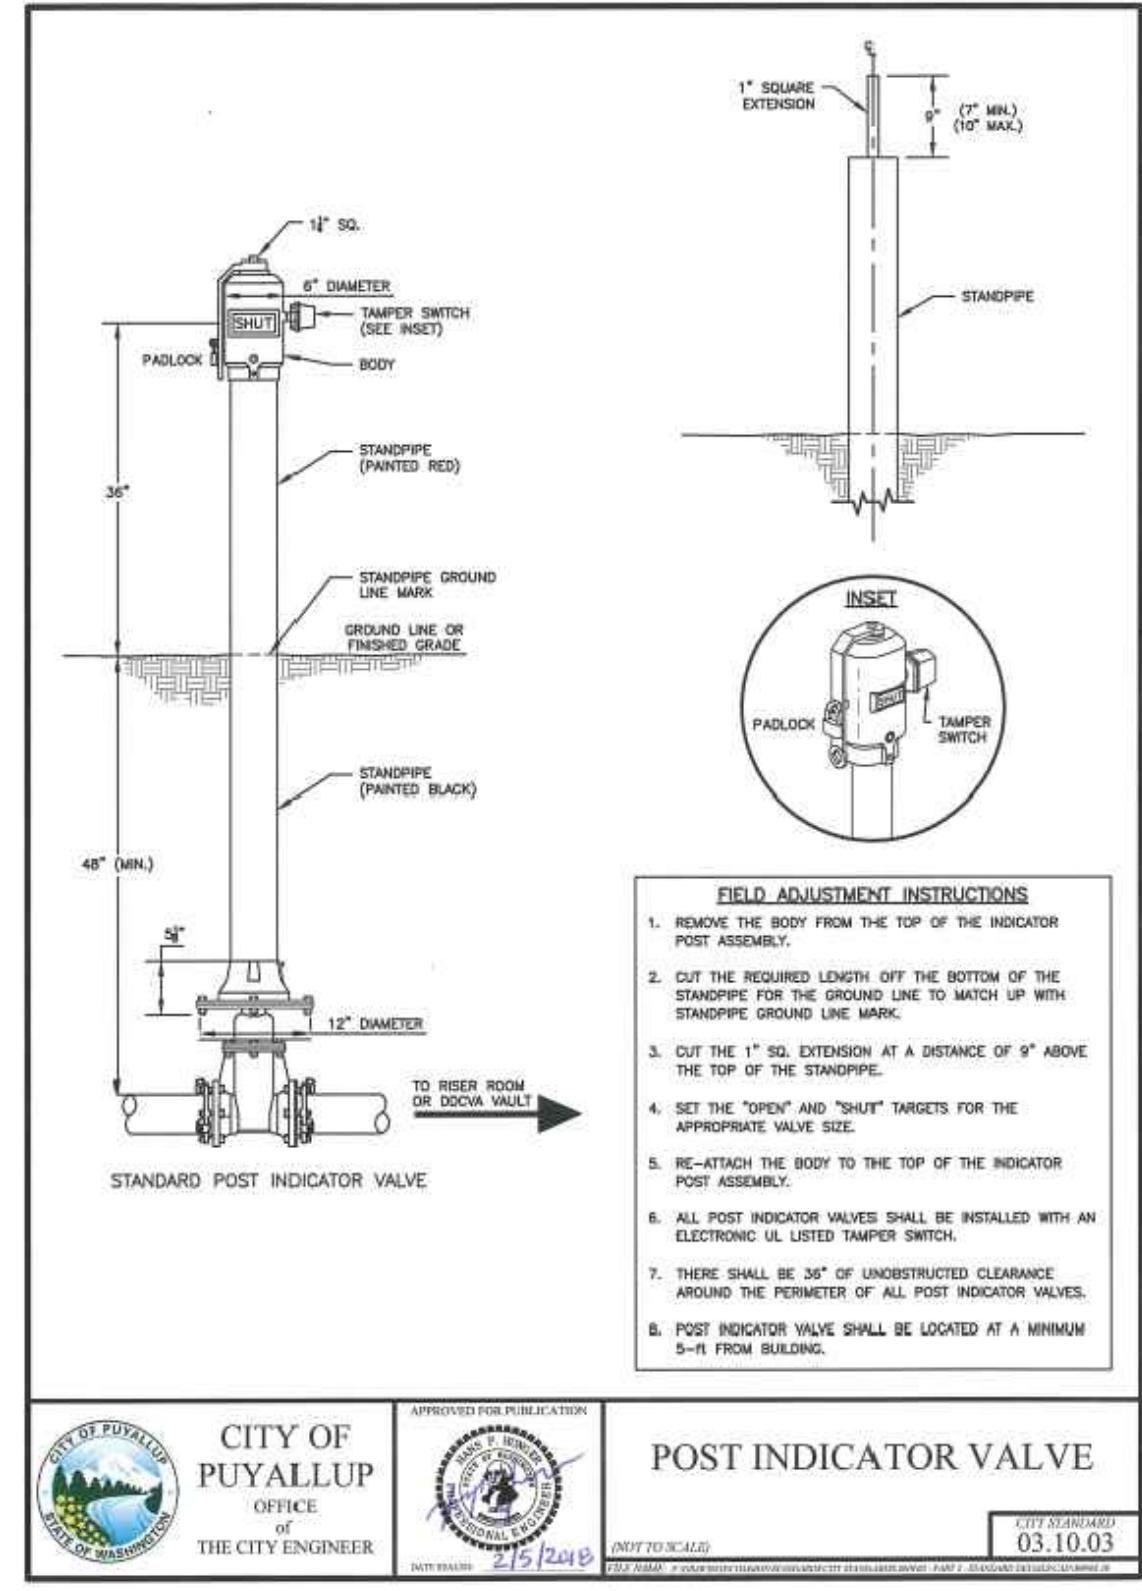

**5 POST INDICATOR VALVE**  
 NOT TO SCALE






# EAST TOWN CROSSING PHASE 1


## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

FIRE HYDRANT/FDC LOCATION/ACCESS APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 FIRE CODE OFFICIAL  
 DATE: 06/04/2024


APPROVED  
 BY: [Signature]  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024

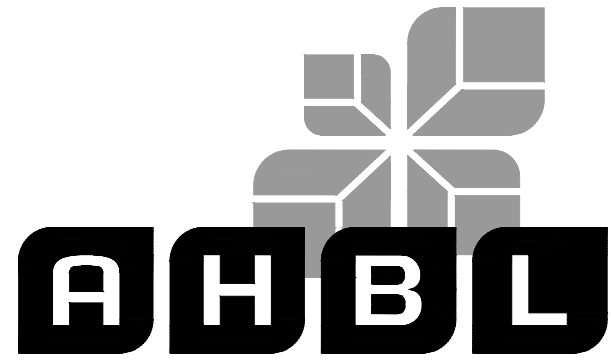


TACOMA · SEATTLE · SPOKANE · TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

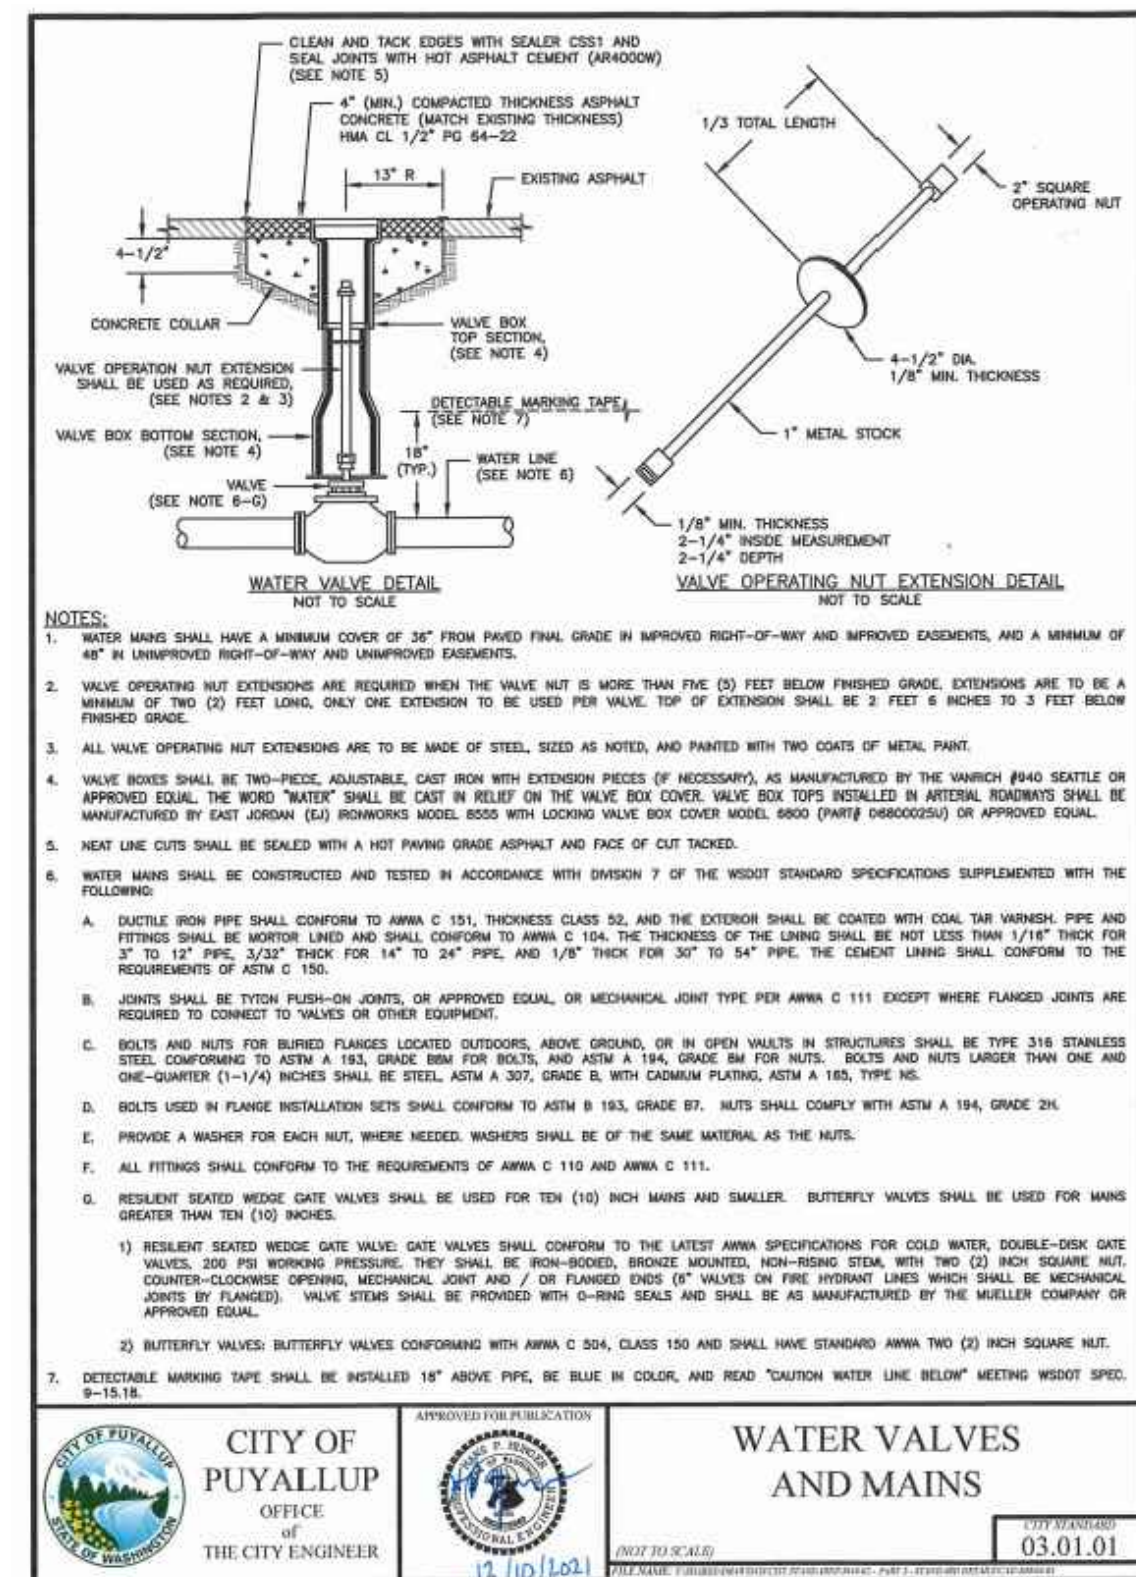


1 WATER VALVES AND MAINS  
 NOT TO SCALE

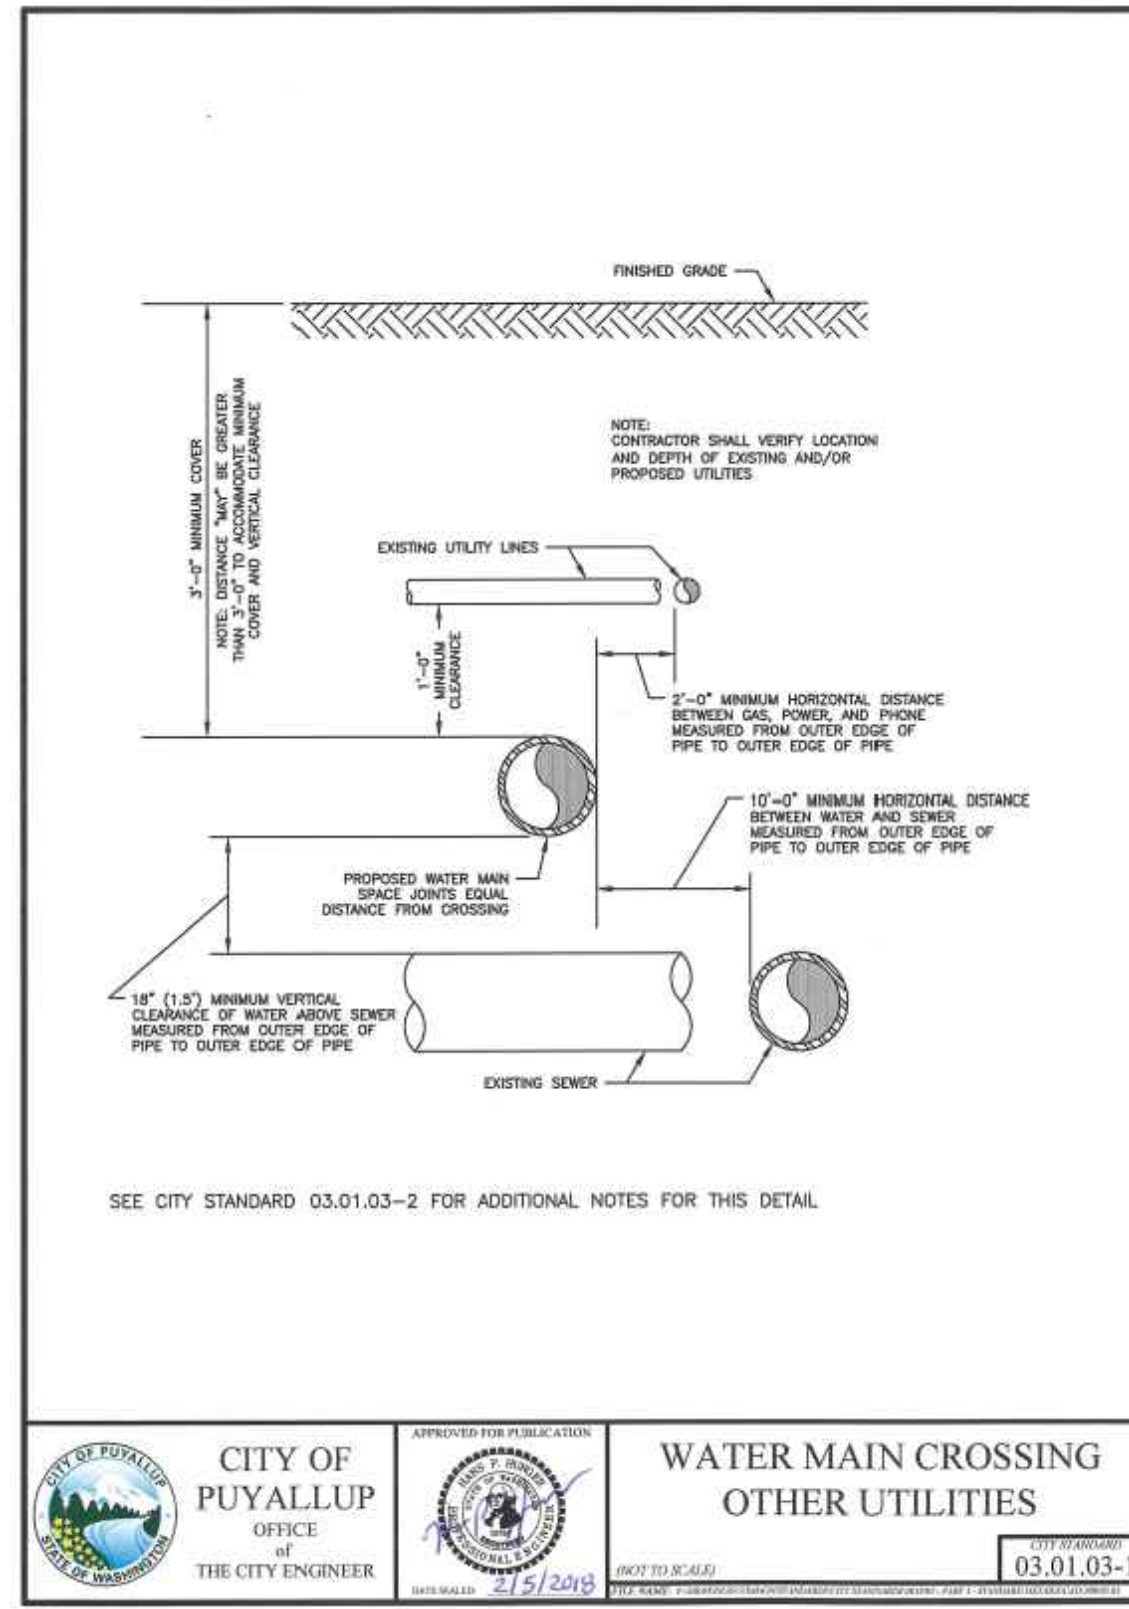


2 WATER MAIN CROSSING OTHER UTILITIES  
 NOT TO SCALE

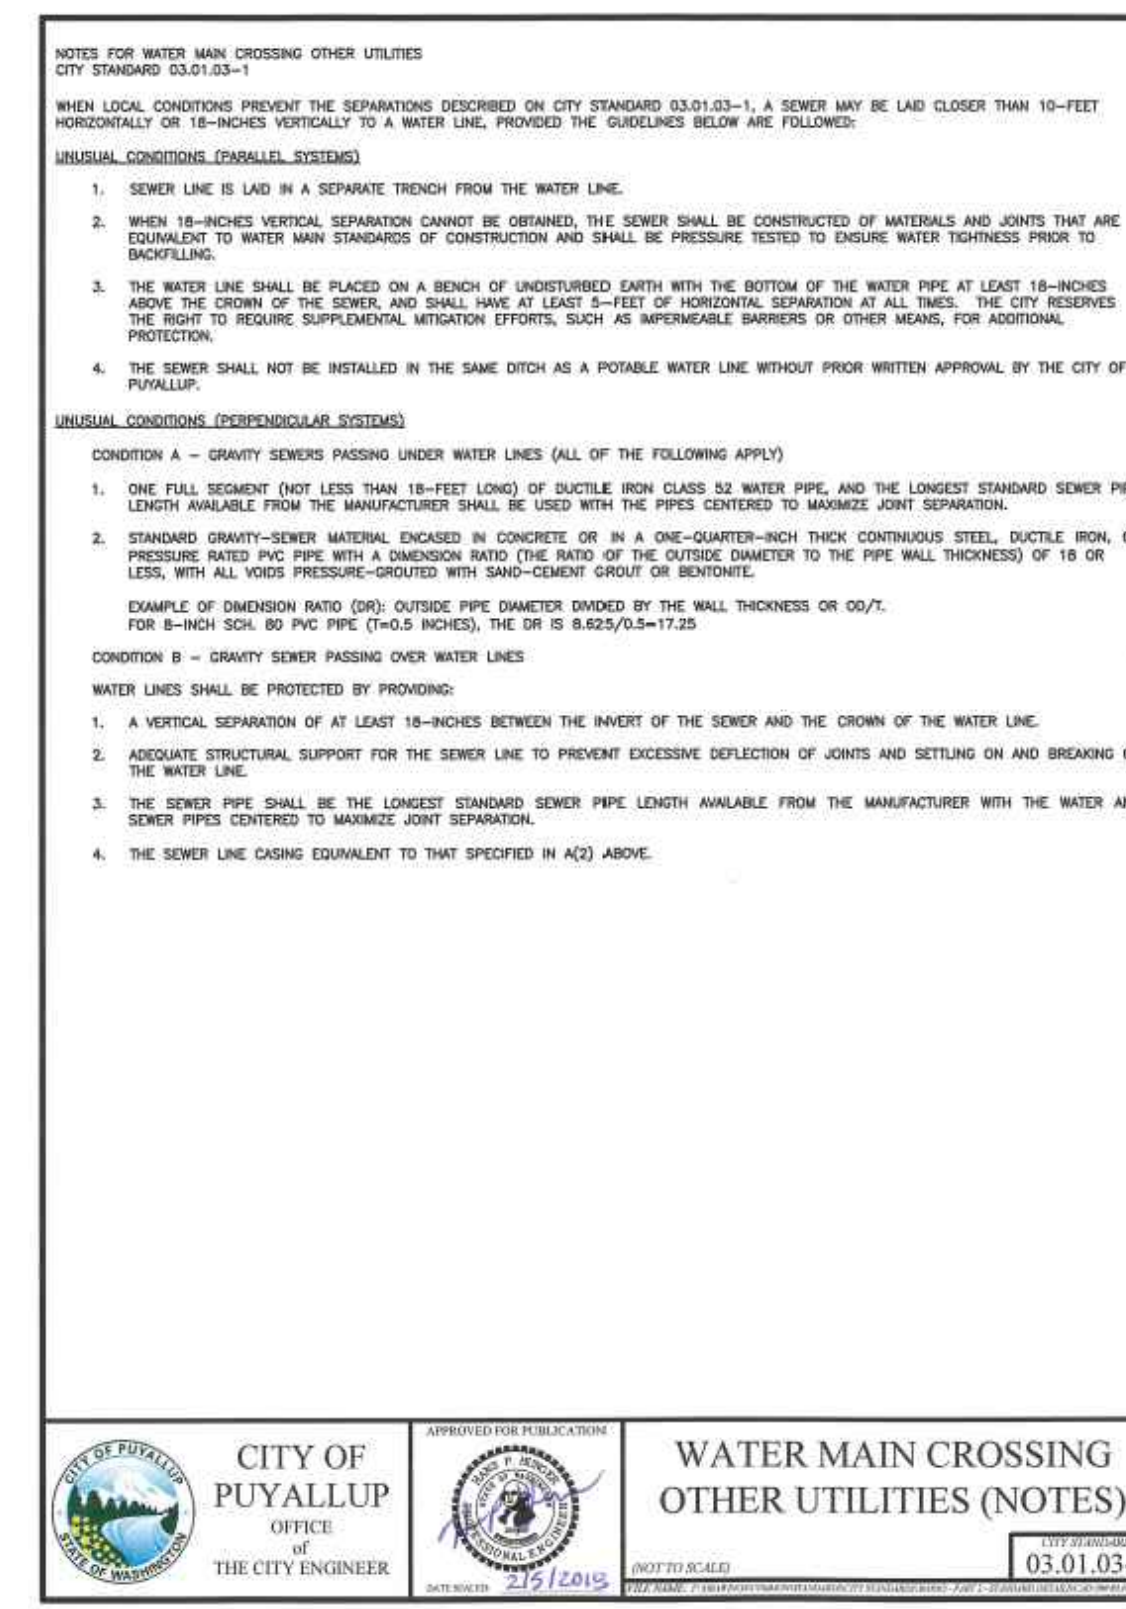

3 WATER MAIN CROSSING OTHER UTILITIES (NOTES)  
 NOT TO SCALE

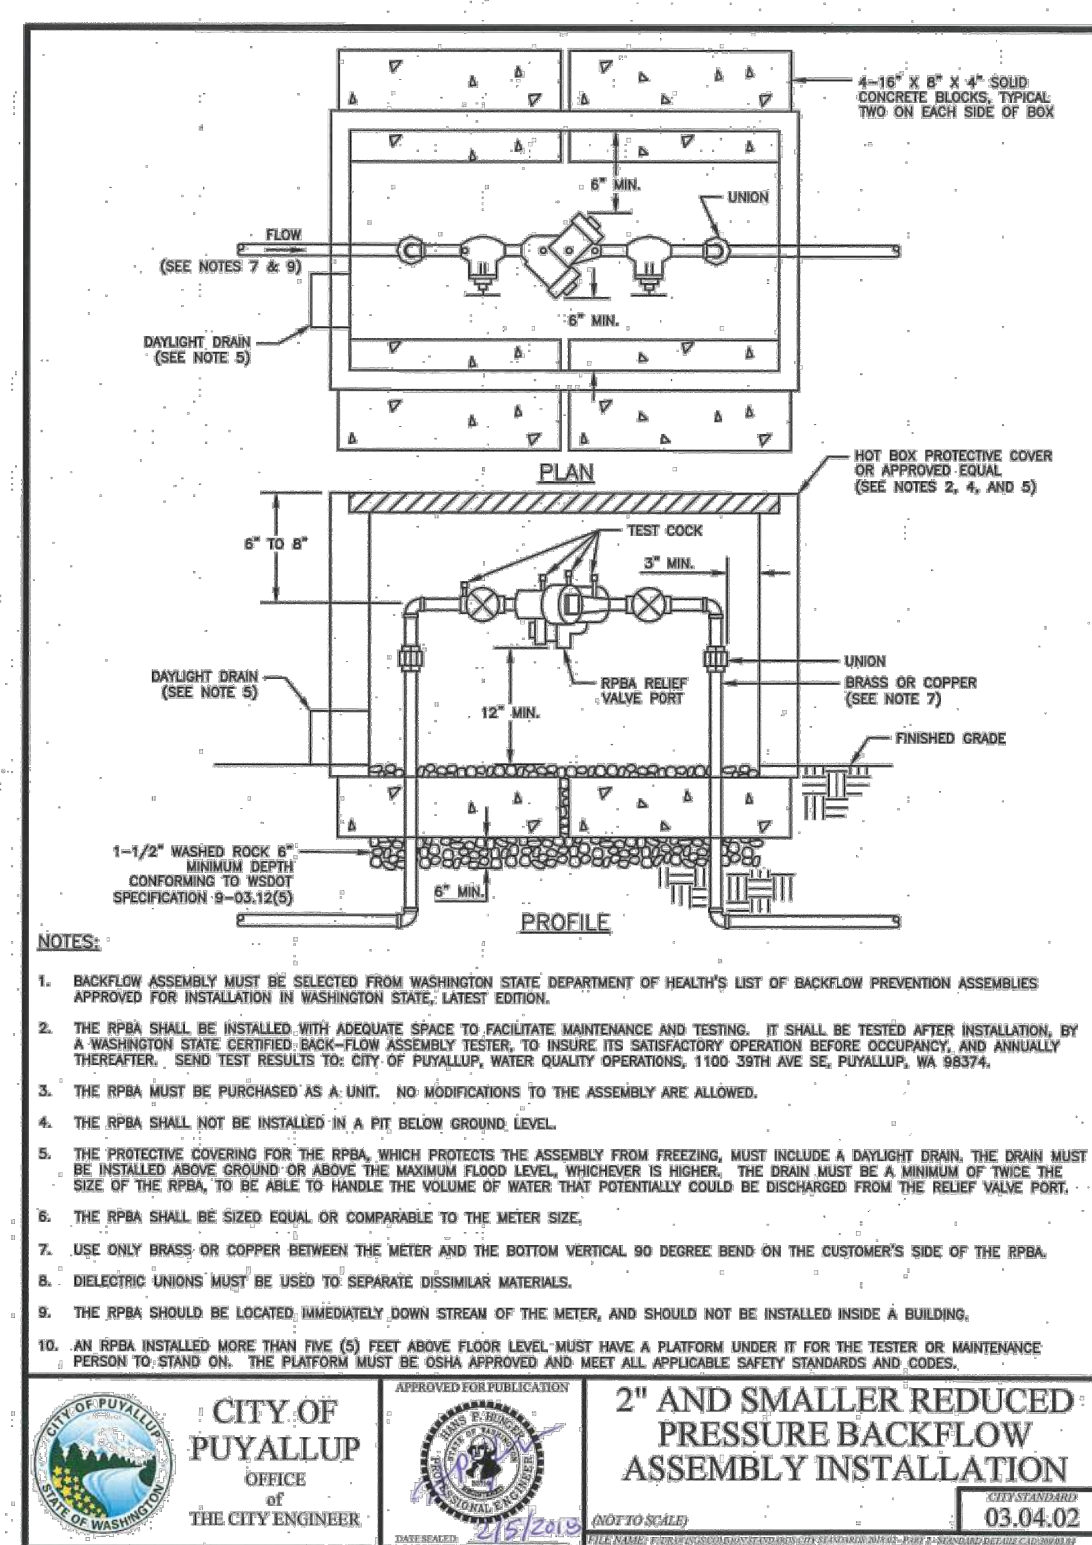

4 2IN AND SMALLER REDUCED PRESSURE BACKFLOW ASSEMBLY INSTALLATION  
 NOT TO SCALE

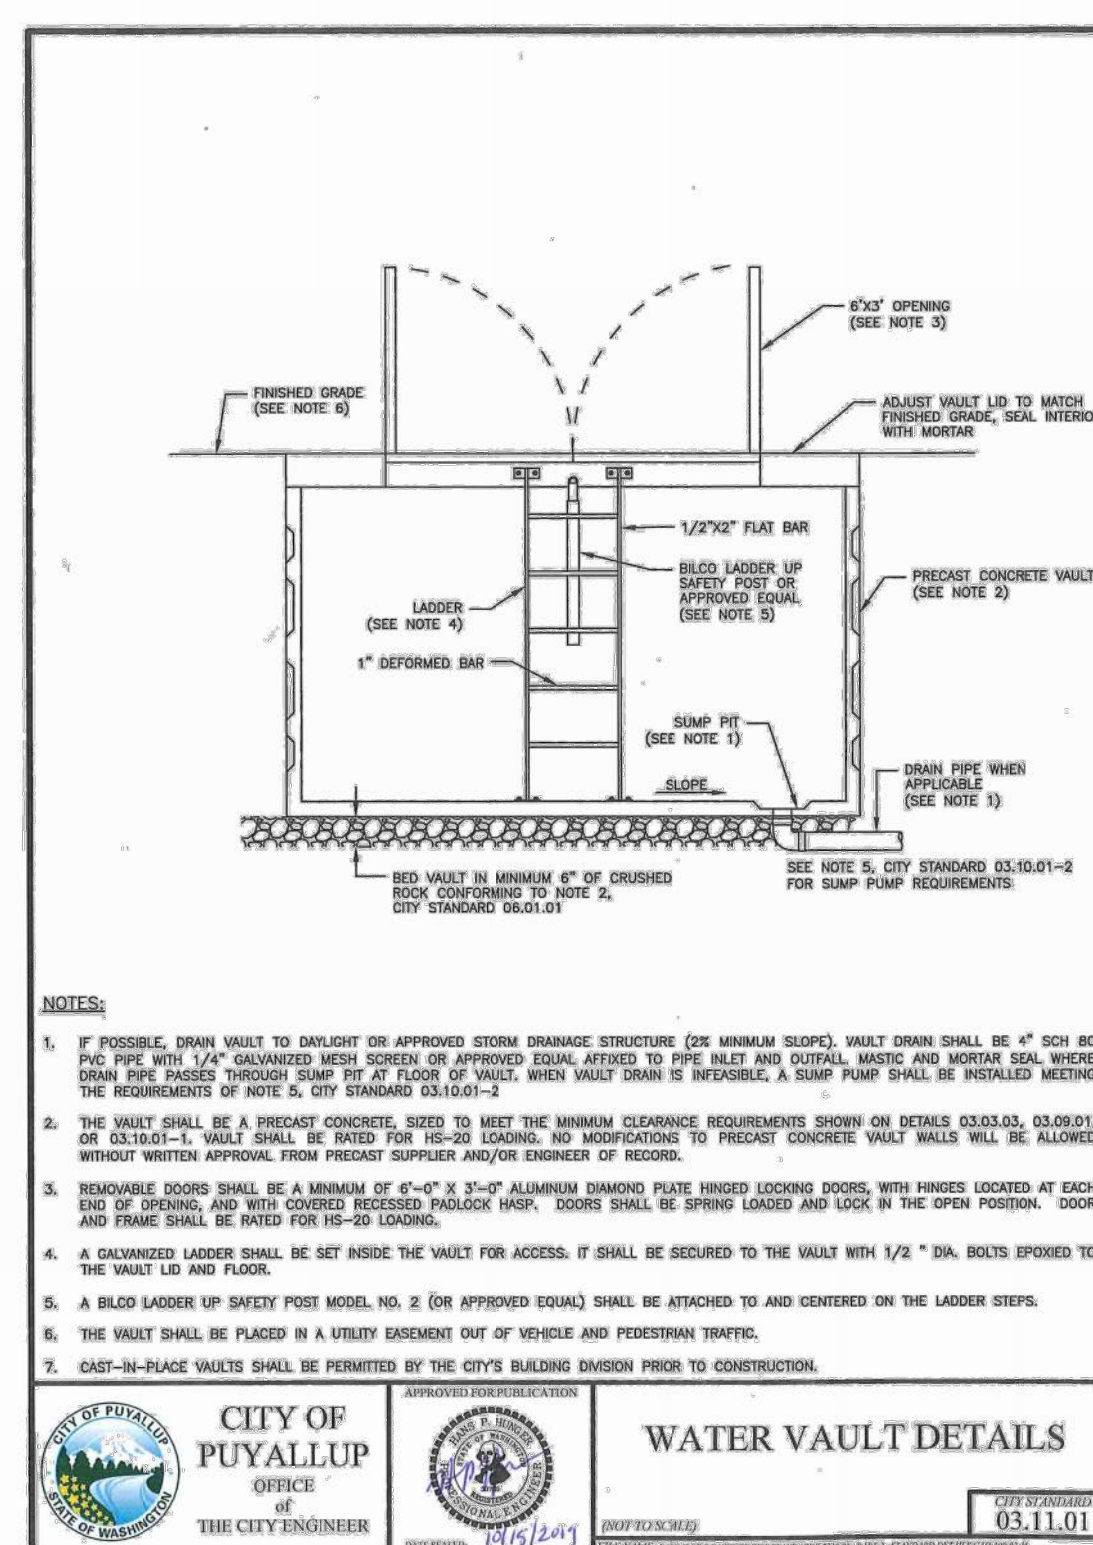

5 WATER VAULT DETAILS  
 NOT TO SCALE

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
**ASH DEVELOPMENT**

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE  
 A SIGNATURE OF THIS DOCUMENT SHALL INDICATE THE PROFESSIONAL SEAL AND SIGNATURE OF THE REGISTERED PROFESSIONAL ENGINEER. THE REGISTERED PROFESSIONAL ENGINEER SHALL BE RESPONSIBLE FOR THE PROJECT EXCEPT IN THE TITLE BLOCK AND NOT BE USED FOR ANY OTHER PROJECT.

**City of Puyallup Development & Permitting Services ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title:

### WATER NOTES AND DETAILS

Designed by: CW  
 Drawn by: SK/RS  
 Checked by: JI


Sheet No.  
**C6.11**  
 52 of 53 Sheets






# EAST TOWN CROSSING PHASE 1

## SEC. 26,35/ TWP. 20 N./ RGE. 4 E., W.M.

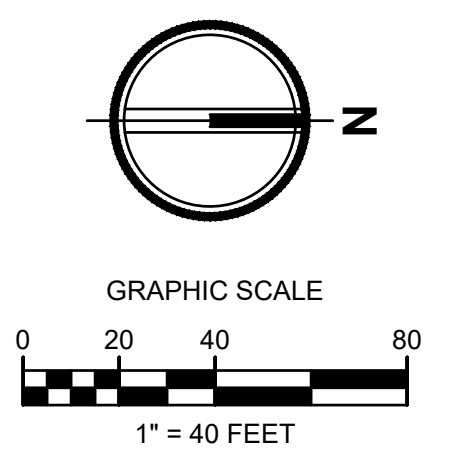

APPROVED  
 BY: *[Signature]*  
 CITY OF PUYALLUP  
 DEVELOPMENT ENGINEERING  
 DATE: 06/06/2024  
 NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

TACOMA • SEATTLE • SPOKANE • TRI-CITIES  
 2215 North 30th Street, Suite 300, Tacoma, WA 98403  
 253.383.2422 TEL 253.383.2572 FAX www.ahbl.com WEB

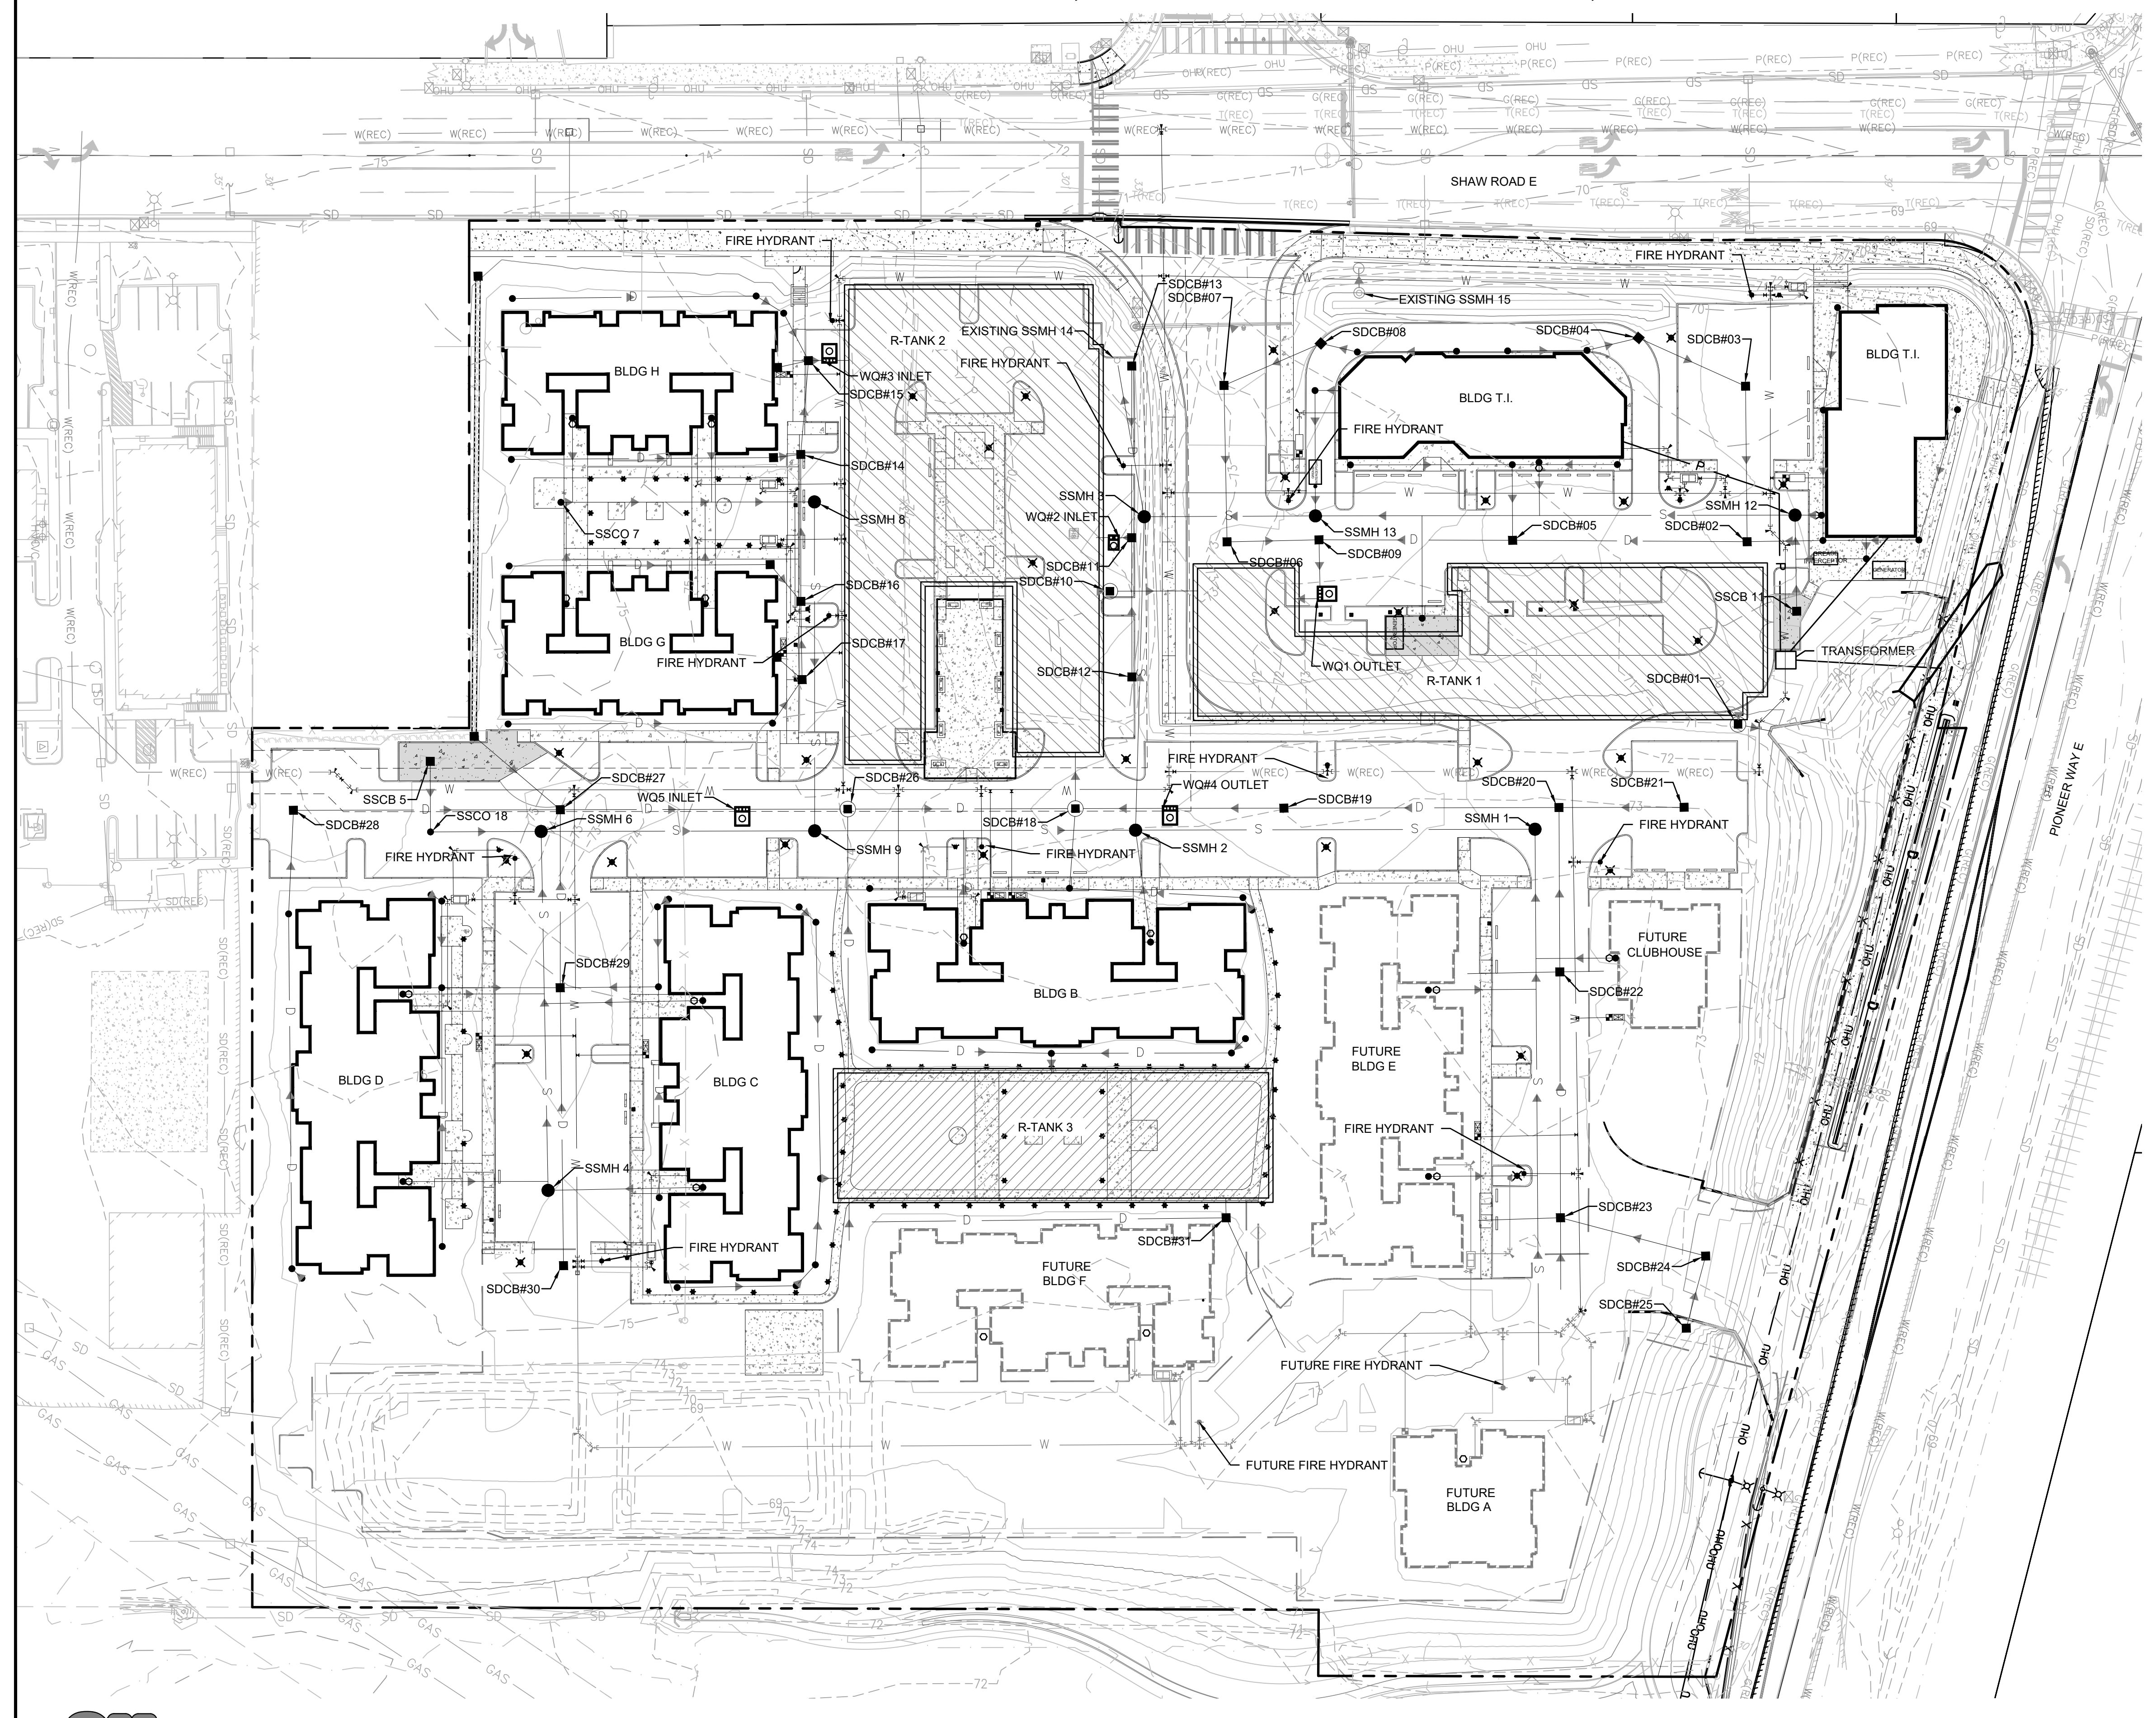

Project Title:  
**EAST TOWN CROSSING PHASE 1**

Client:  
 ASH DEVELOPMENT

GREG HELLE  
 GREG.HELLE@ASHNW.COM

Project No.  
 2230752

Issue Set & Date:  
**PERMIT SUBMITTAL**  
 05/17/2024



NOTICE  
 A REVISION OF THIS DOCUMENT SHALL VALIDATE THE PROFESSIONAL SEAL AND SIGNATURE PUBLICATION OF THE DOCUMENT DOES NOT REMOVE FROM REVISIONS OR CHANGES MADE TO IT. THE ORIGINAL OF THE ORIGINAL SET OF THIS DOCUMENT IS THE ONLY SET TO BE USED FOR PERMITS, RECORDS, OR ACTION TO THAT PROJECT OR FOR ANY OTHER PROJECT.

City of Puyallup  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

03/29/24 CITY COMMENTS

01/29/24 CITY COMMENTS

Revisions:

Sheet Title:

### OVERALL UTILITY PLAN

Designed by: CW  
 Drawn by: SK / RS  
 Checked by: JI

Sheet No.  
**C7.0**  
 53 of 53 Sheets

