

NOTES:

1. ROOF DRAIN SHALL PROVIDE POSITIVE FLOW FROM DOWNSPOUTS (DS) TO YARD DRAINS.
2. YARD DRAINS SHALL BE INSTALLED UPSTREAM OF EACH DOWNSPOUT INFILTRATION TRENCH IN ACCORDANCE WITH STD DETAIL 02.05.02.
3. TRENCH BOTTOM SHALL BE A MINIMUM OF 1' ABOVE SEASONAL HIGH GROUNDWATER OR IMPERMEABLE SOIL LAYER.
4. TRENCH SHALL BE DESIGNED IN ACCORDANCE WITH SECTION 210.2.
5. INFILTRATION TRENCH SHOULD NOT BE INSTALLED UNDER IMPERVIOUS SURFACES.
6. CLEANOUT(S) SHALL BE INSTALLED IN ACCORDANCE WITH STD DETAIL 02.01.09.
7. NON-WOVEN GEOTEXTILE TO CONFORM TO WSDOT 9-33.2(1), TABLE 1 AND 2.

City of Puyallup	ISSUED
Checked	DESIGN
Engineering	Public Works
File	Traffic




CITY OF PUYALLUP
PUBLIC WORKS AND DEVELOPMENT ENGINEERING




DOWNSPOUT INFILTRATION TRENCH

SCALE NTS	DATE REVISED: 05/19/2023	CITY STANDARD
FILE NAME: Y:\Shared\Drawings\City Standards\2018\02 - PART 2 - STANDARD DETAILS\CAD\200\02.05.01		02.05.01

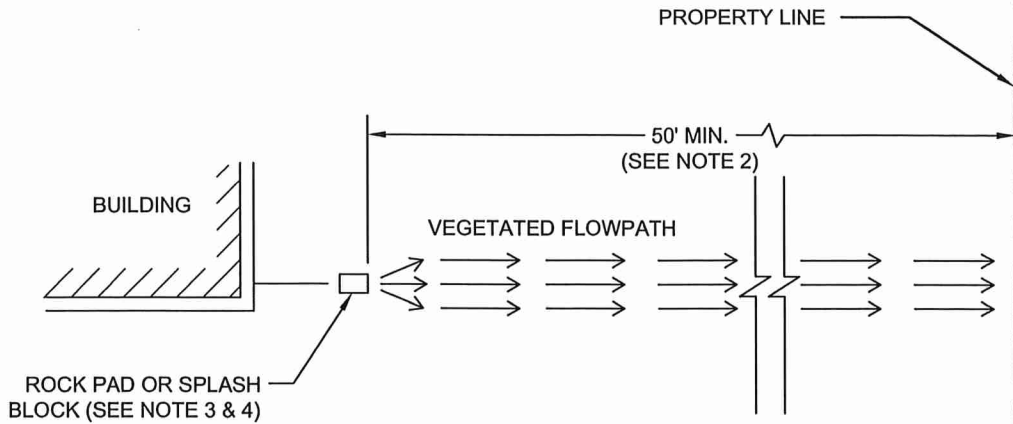

PLAN VIEW

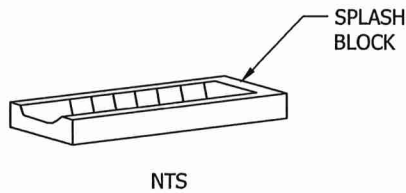

ROOF DOWNSPOUT
SERVES UP TO
700 S.F. OF ROOF

BUILDING

DOWNSPOUT EXTENSION

COMMERCIAL SPLASH BLOCK OR ROCK PAD WITH
DIMENSIONS 2'x3'x8" (SEE NOTE 3 & 4) (SLOPE AWAY FROM
DISCHARGE POINT)

50' MIN. VEGETATED
FLOW PATH



PROFILE VIEW

NOTES:

1. SPLASH BLOCKS SHALL BE DESIGNED IN ACCORDANCE WITH SECTION 210.4.
2. THE VEGETATED FLOW PATH SHALL BE MEASURED FROM THE SPLASH BLOCK (DISCHARGE POINT) AND MEASURED PERPENDICULAR TO SITE CONTOURS.
3. SPLASH BLOCKS SHALL BE CONCRETE, PLASTIC, OR SIMILAR MATERIAL. COMMERCIALY AVAILABLE SPLASH BLOCKS GENERALLY MEET DESIGN CRITERIA.
4. ROCK PAD SHALL CONSIST OF 4" COBBLES PER WSDOT 9-03.11(2).



**CITY OF
PUYALLUP**
PUBLIC WORKS AND
DEVELOPMENT ENGINEERING

APPROVED FOR PUBLICATION



DATE SEALED: 10/23

**DOWNSPOUT
SPLASHBLOCK**

SCALE
NTS

DATE REVISED:
04/17/2023

CITY
STANDARD

FILE NAME: Y:\Shared\Drawings\City Standards\2018\02 - PART 2 -
STANDARD DETAILS\CAD\200\02.05.05

02.05.05