

REPLACE SEC CONN BARS W/ 8 POS BARS CONNECT & TAG CUSTOMER RAN UG SVC LINES (2 RUNS OF 1/0KCM) (RUNS ARE FOR HOUSE METER NORTH BUILDING ONLY) INST SECONDARY CONCRETE HANDHOLE 233 W/10-350 8 POS 3-22 INST LID GRND CONNECT & TAG CUSTOMER RAN UG SVC LINES (2 RUNS OF 250KCM) (RUNS ARE FOR UNIT 6 METER STACK NORTH BUILDING) CONNECT & TAG CUSTOMER RAN UG SVC LINES (2 RUNS OF 250KCM) (RUNS ARE FOR UNIT 6 METER STACK SOUTH BUILDING) CONNECT & TAG CUSTOMER RAN UG SVC LINES (1 RUN OF 1/0KCM) (RUN IS FOR HOUSE METER SOUTH BUILDING)

V01 TO HH1: INST PSE PROVIDED 2 - 3" CONDUIT ±100FT IN CUST PROVIDED TRENCH (200)2-54A ___)(ACTUAL:____) INST PSE PROVIDED 2 - 350MCM UG TPLX ±100FT IN CUST PROVIDED TRENCH ___)(ACTUAL:____

M01 / M08: OFFICE & FIRE METER M02 THRU M07:

M09 THRU M14:


MAPS & RECORDS: EXISTING HH & SEC ALREADY RMVD BY CUSTOMER

CUSTOMER NOTES: SITE MUST BE READY 1 WEEK PRIOR TO CONSTRUCTION CUSTOMER TO PROVIDE ALL TRENCHING AND EXCAVATION

⊣BØ−15843 119' AØ-15840 BØ-15841 CØ-15842 HCØ-AAP536 580' 566872-155697 (VOD). 566872-155706 100 kVA 120/240V (C) AØ-AAN912 H ⊣CØ−AAP536 118'


UNDERGROUND ONE-LINE DIAGRAM

SCALE: NONE

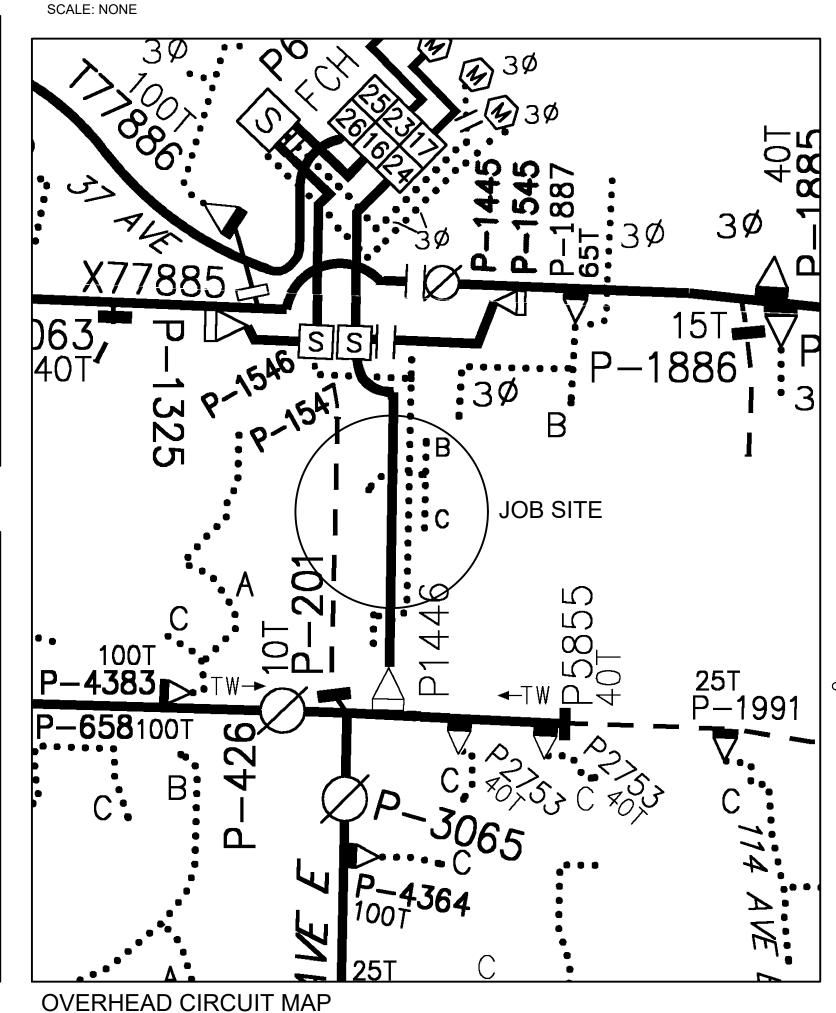

POWER GENERAL NOTES - MULTIFAMILY PROJECT

- All materials to be installed in accordance with Puget Sound Energy's (PSE) standards. Any deviation from this work sketch must be AUTHORIZED by PSE's Project Manager and NOTED on the Foremans' Copy.
- All switching arrangements and/or outage arrangements are to be made with the Project Manager at least three (3) working days in advance.
- Contact the Utilities Underground Location Center (1-800-424-5555) at least 48 hours prior to commencing
- 4. STAKING: The customer will provide all staking (transformer, handhole, trench, grade, lot, pole, sidewalk, etc.). See sketch and details for locations. Equipment locations must be approved by the Project Manager.
- 5. SITE PREPARATION: The work area will be at or near finished grade, clear of trench spoils or construction
- 6. Roads shall be paved or have a compacted, crushed rock base in place.
- 7. CLEARANCES: Transformers require a minimum of 6 feet from fire fighting equipment, 10 feet from combustible walls, overhangs, doors, and windows, and a minimum of 5 feet from the back of curb (or guard posts will be required per PSE standards). All conduits and vaults are to be at least 5 feet away from water,
- 8. All work is to be done in accordance with local municipal and county permit requirements as applicable.
- 9. Customer/Developer is responsible to provide, install and maintain all secondary service cables, conduits and crossings from the individual unit's meter base to the designated connection point.
- 10. Inclement weather conditions may cause delays in construction times and dates.
- 11. EXCAVATION: The customer is to provide all trenching, backfill, vault excavations, compaction and restoration per this sketch and per PSE standards. A minimum protective cover of 36" is required over PSE's primary voltage equipment and 24" is required of PSE's secondary voltage equipment. The customer will provide any and all shoring or they will side slope the trench to 1:1.

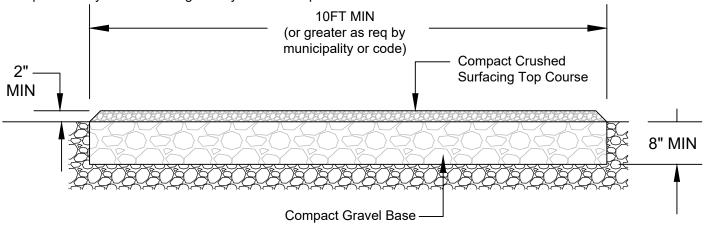

CUSTOMER-PSE REQUIRED EQUIPMENT ACCESS ROAD

SCALE: NONE

PRFUP20241175

City of Puyallup

Building

Engineering

Fire

ISSUED PERMIT


opment & Permitting Service

Planning


Public Works


Vicinity Map

0150.3200 TECHNIQUES FOR TEMPORARY EROSION & SEDIMENT CONTROL & ANY ADDITIONAL LOCAL JURISDICTION REQUIREMENTS (LOCAL JURISDICTIONS MAY HAVE ADDITIONAL REQUIREMENTS INCLUDING NOTES DETAILING WHERE EROSION OR SEDIMENT CONTROL STRUCTURES ARE TO BE INSTALLED, CROSS SECTION DETAILS OF THE TYPICAL EROSION

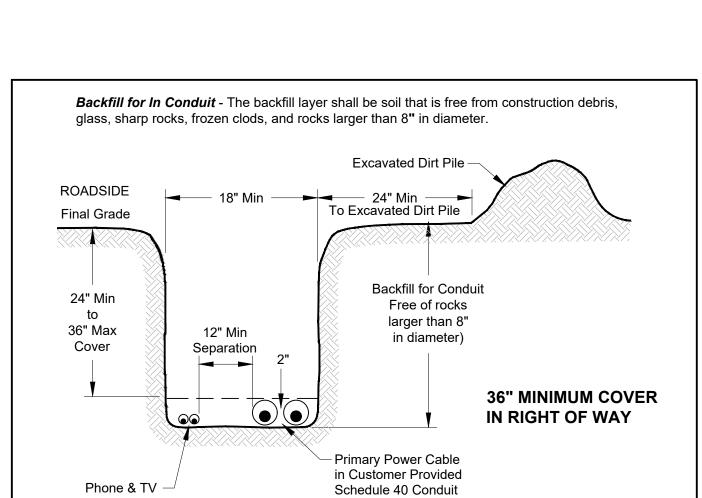



CUSTOMER-SUPPLIED TRENCH FOR SECONDARY DISTRIBUTION (V01 TO HH1)

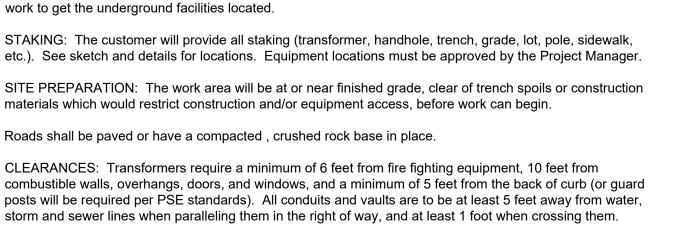

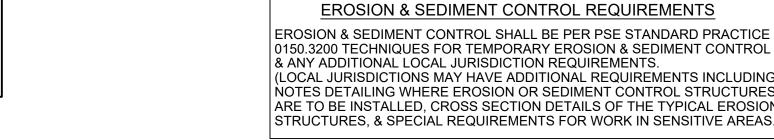


FOREMAN (CHECK BOX WHEN COMPLETED)

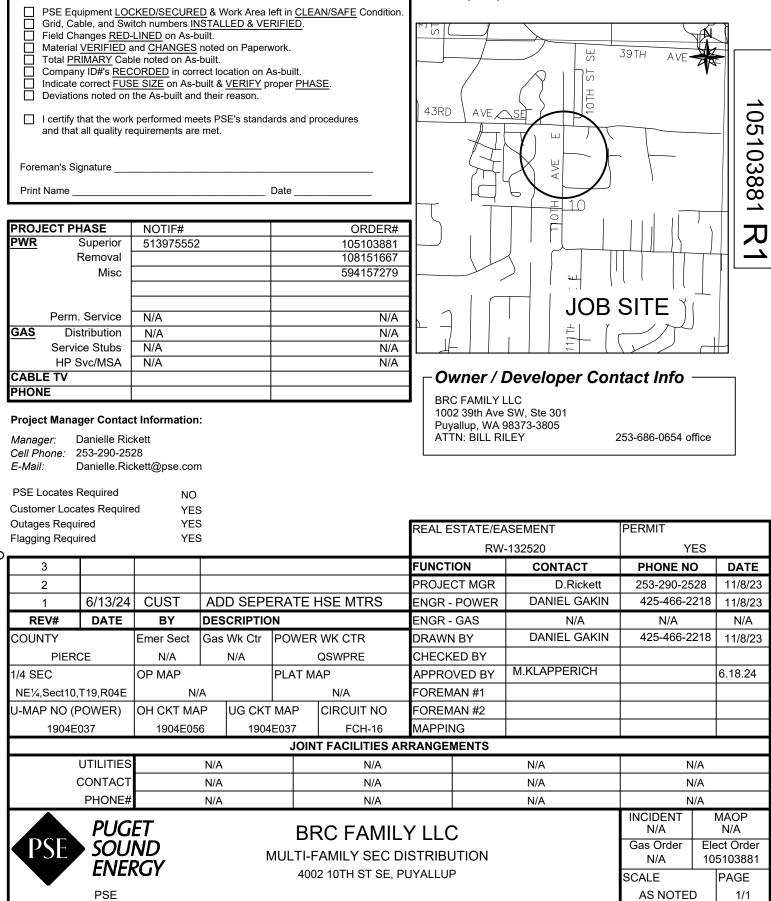

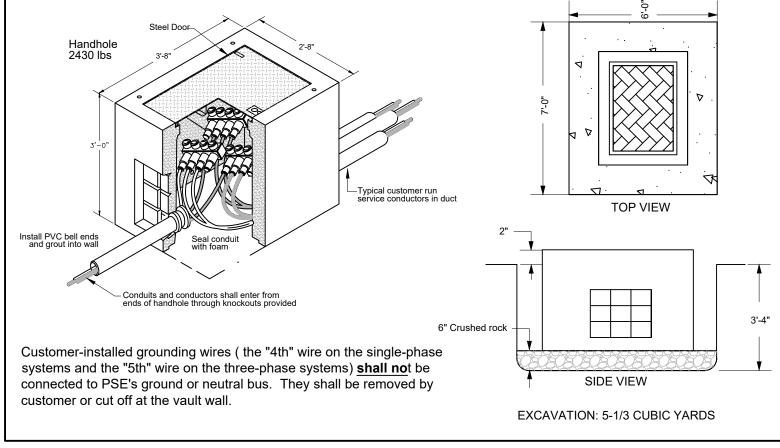

CUSTOMER-SUPPLIED HANDHOLE EXCAVATION (HH1)

SCALE: NONE

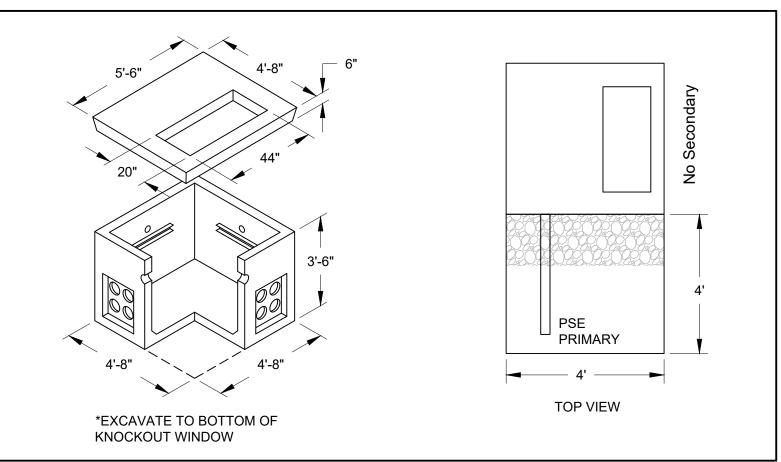

CUSTOMER-SUPPLIED EXCAVATION ATE VAULT (V01) SCALE: NONE

SCALE: NONE