




PO Box 110 • 9493 Porter Rd • Aumsville, OR 97325  
800.682.1422 ModernBuildingSystems.com

JOB #2023-LU 2514-2515 Puyallup SD

CALCULATED BY MCL DATE 5/30/2023

CHECKED BY DATE

SCALE



PRPF20241043

STRUCTURAL FOUNDATION CALCULATIONS (PER 2021 IBC) FOR  
28' X 64' MODULAR

MATERIAL SUMMARY

MS-1

FOUNDATION ANALYSIS

FDN-1 --> FDN-8

LOADING ANALYSIS

L-1 --> L-6

REUSE OF DOCUMENTS: THIS DOCUMENT AND THE IDEAS AND DESIGNS INCORPORATED HEREIN ARE THE PROPERTY OF MODERN BUILDING SYSTEMS INC. AND ARE NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER USE OR PROJECT WITHOUT WRITTEN AUTHORIZATION

5/31/2023





PO Box 110 • 9493 Porter Rd • Aumsville, OR 97325  
800.682.1422 ModernBuildingSystems.com

**JOB #2023-LU 2514-2515 Puyallup SD**

SHEET NO MS-1 OF MS-1

CALCULATED BY MCL DATE 5/30/2023

CHECKED BY DATE

SCALE

**MATERIAL SUMMARY FOR**  
**28' X 64' MODULAR**

**FOUNDATION:**

TYP EXT FTG	USE	USE +/- 16 in. SQ. PADS OR 2 x 12 x 24 in. P.T. PADS AT 6' O.C.	SEE FDN-1
TYP INTERIOR FTG	USE	USE +/- 16 in. SQ. PADS OR 2 x 12 x 24 in P.T. PADS AT 6' O.C.	SEE FDN-1
ENDWALL COLUMN FTG	USE	(2) (FLAT) P.T. HF #2, 6 x 8 x 4 ' L	SEE FDN-3,5
CNTR COLUMN FTG	USE	(5) (FLAT) P.T. HF #2, 4 x 8 x 4 ' L	SEE FDN-3,6
CNTR COLUMN FTG POST	USE	(2) DF #2, 6 x 10 x 3 ' L	SEE FDN-3,7
MOD TRANSVERSE ANCHORS	USE	USE MIN (4) HOLD DOWNS AT EA SIDEWALL	SEE FDN-4
MOD LONGITUDINAL ANCHORS	USE	USE MIN (3) HOLD DOWNS AT EA ENDWALL	SEE FDN-4



PO Box 110 • 9493 Porter Rd • Aumsville, OR 97325  
 800.682.1422 ModernBuildingSystems.com

**JOB # 2023-LU 2514-2515 Puyallup SD**

SHEET NO FDN-1	OF FDN-8
CALCULATED BY MCL	5/30/2023
CHECKED BY	DATE

**FOUNDATION DESIGN**

**MODULAR**

BUILDING LENGTH (L) = 64.00 '  
 BUILDING WIDTH (B) = 27.67 '  
 FRAME RAIL OFFSET = N/A  
 FLOOR TRIB WIDTH = 6.92 '  
 ROOF OVERHANG = 0.50 '  
 ROOF TRIB WIDTH = 7.42 '  
 WALL PLATE HEIGHT = 8.00 ' (ABOVE F.F.)  
 TRANSVERSE WIND/SEIS. = 7987 #  
 LONGIT. WIND/SEIS. = 4778 #  
 WIND UPLIFT = 18772 #  
 SNOW LOAD = 25 psf  
 BUILDING WEIGHT = 44363 # (No solar or snow)  
 F.F. HEIGHT = 2.50 ' (ABOVE GRADE)  
 AVG. ROOF HEIGHT = 13.00 ' (ABOVE GRADE)  
 PIER PAD AREA = 1.78 ft<sup>2</sup>

SITE TYPE = GRAVEL  
 MAX BRG PRESSURE = 1800 psf

**AT EXTERIOR FTG**

LOAD TO SKIRTWALL = 0 plf

DL = 7.42'(12 psf)+8'(10 psf)+6.92'/2(10 psf) = 204 plf

LL = 6.92' / 2 X 50 psf = 173 plf

SL = 7.42' X 25 psf = 185 plf

D + L = 376 plf

D + S = 389 plf

D + 0.75L + 0.75S = 472 plf

**CONTROLS**

PIER SPACING = 6.00 '

q = (472plf - 0plf) X (6') / 1.78 ft<sup>2</sup> = 1592 psf

∴ OK on GRAVEL

USE +/- 16 in. SQ. PADS OR 2 x 12 x 24 in. P.T. PADS AT 6' O.C.

**AT INTERIOR FTG - (U.N.O.)**

DL = 6.92' (10 psf) = 69 plf

LL = 6.92' (50 psf) = 346 plf

D + L = 415 plf

**CONTROLS**

PIER SPACING = 6.00 '

q = 415plf X (6') / 1.78 ft<sup>2</sup> = 1399 psf

∴ OK on GRAVEL

USE +/- 16 in. SQ. PADS OR 2 x 12 x 24 in P.T. PADS AT 6' O.C.



PO Box 110 • 9493 Porter Rd • Aumsville, OR 97325  
**800.682.1422** ModernBuildingSystems.com

**JOB # 2023-LU 2514-2515 Puyallup SD**

SHEET NO FDN-2	OF FDN-8
CALCULATED BY MCL	5/30/2023
CHECKED BY	DATE
SCALE	

**AT ENDWALL COLUMN FTG**

COLUMN DL = 1992 #

COLUMN SL = 4149 #

DL = [3' (10 psf) + 10.5' (10 psf)] X 6.92' = 934 #

LL = 3' (50 psf) X 6.92' = 1037 #

D + L = 3963 #

D + S = 7075 #

D + 0.75L + 0.75S = 6815 #

**CONTROLS**

<9000# Therefore OK. (See FDN- 3,5 )

**AT MIDSPAN COLUMN FTG**

COLUMN DL = 6638 #

COLUMN SL = 13830 #

DL = 6.92' (10 psf) (6') = 415 #

LL = 6.92' (50 psf) (6') = 2075 #

D + L = 9127 #

D + S = 20883 #

D + 0.75L + 0.75S = 18981 #

**CONTROLS**

<21600# Therefore OK. (See FDN- 3,6,7 )



PO Box 110 • 9493 Porter Rd • Aumsville, OR 97325  
800.682.1422 ModernBuildingSystems.com

IOB # 2023-LU 2514-2515 Puyallup SD

SHEET NO FDN-3	OF FDN- 8
CALCULATED BY MCL	5/30/2023
CHECKED BY	DATE
SCALE	

**@ ENDWALL COLUMN FOOTING**

TRY 2 (FLAT) P.T. HF #2, 6 x 8 x 4.00' L  
Width (b) each = 0.63'

Pmax = 1800psf X 2 X 0.63' X 4' = 9000 #

DL % = 41%  
SL % = 59%

W<sub>DL</sub> = 1800psf X 0.63' X 0.41 = 465 plf  
W<sub>SL</sub> = 1800psf X 0.63' X 0.59 = 660 plf

**@ MIDSPAN COLUMN FOOTING**

TRY 5 (FLAT) P.T. HF #2, 4 x 8 x 4.00' L  
Width (b) each = 0.60'

Pmax = 1800psf X 5 X 0.6' X 4' = 21600 #

DL % = 34%  
SL % = 66%

W<sub>DL</sub> = 1800psf X 0.6' X 0.34 = 365 plf  
W<sub>SL</sub> = 1800psf X 0.6' X 0.66 = 715 plf

**@ MIDSPAN INTERMEDIATE POST**

TRY 2 DF #2, 6 x 10 x 3.00' L  
Width (b) each = 0.46'

W<sub>DL</sub> = 1800psf X 4' X 0.34 / 2 MEMBERS = 1216 plf  
W<sub>SL</sub> = 1800psf X 4' X 0.66 / 2 MEMBERS = 2384 plf



PO Box 110 • 9493 Porter Rd • Aumsville, OR 97325  
 800.682.1422 ModernBuildingSystems.com

**IOB # 2023-LU 2514-2515 Puyallup SD**

SHEET NO FDN-4	OF FDN- 8
CALCULATED BY MCL	5/30/2023
CHECKED BY	DATE
SCALE	

**MOD TRANSVERSE LOADING ANCHORAGE**

Sliding:	N =	7987# / 2094# =	4 ANCHORS
Overturning:	Mot =	$7987\# / 2 \times 13' + 7987\# / 2 \times 2.5' + 18772\# \times 27.67' / 2 =$	322 k-ft
	Mr =	$44363\# \times 27.67' / 2 =$	614 k-ft
	w/ ANCHORS =	$4 \times 2094\# \times 27.67' =$	232 k-ft
	TOTAL =	$(614\text{k-ft} \times 0.6) + 232\text{k-ft} =$ > 322k-ft therefore OK	600 k-ft

MIN NUMBER = 4 ANCHORS

USE MIN (4) HOLD DOWNS AT EA SIDEWALL

**MOD LONGITUDINAL LOADING ANCHORAGE**

Sliding:	N =	4778# / 2094# =	3 ANCHORS
Overturning:	Mot =	$4778\# / 2 \times 13' + 4778\# / 2 \times 2.5' + 18772\# \times 64' / 2 =$	638 k-ft
	Mr =	$44363\# \times 64' / 2 =$	1420 k-ft
	w/ ANCHORS =	$3 \times 2094\# \times 64' =$	402 k-ft
	TOTAL =	$(1420\text{k-ft} \times 0.6) + 402\text{k-ft} =$ > 638k-ft therefore OK	1254 k-ft

MIN NUMBER = 3

USE MIN (3) HOLD DOWNS AT EA ENDWALL

**MOBILE UNIT CONNECTION TO CHASSIS**

(TRANSVERSE LOADING)	T = $322 \text{ k-ft} - (0.6) \times 614 \text{ k-ft} / 27.67 \text{ ft} / 2 =$	-843 #
	PER NAIL VALUE (SIMP C-2019 PG 263)	211 # DF
	PER STRAP	12
	N=	12 NAILS (MIN)

N/A

## Wood Beam

Project File: 2023-LU 2514-2515 2021 IBC Struct Calcs.ec6

LIC#: KW-06013980, Build:20.23.05.22

MODERN BUILDING SYSTEMS

(c) ENERCALC INC 1983-2023

**DESCRIPTION:** ENDWALL COLUMN FTG - 2023-LU 2514-2515

### CODE REFERENCES

Calculations per NDS 2018, IBC 2021, ASCE 7-16

Load Combination Set : IBC 2021


### Material Properties

Analysis Method : Allowable Stress Design  
Load Combination IBC 2021

Wood Species : Hem-Fir  
Wood Grade : No.2

Beam Bracing : Completely Unbraced

Fb +	575.0 psi	E : Modulus of Elasticity	
Fb -	575.0 psi	Ebend- xx	1,100.0ksi
Fc - Prll	575.0 psi	Eminbend - xx	400.0ksi
Fc - Perp	405.0 psi		
Fv	140.0 psi		
Ft	375.0 psi	Density	26.840pcf

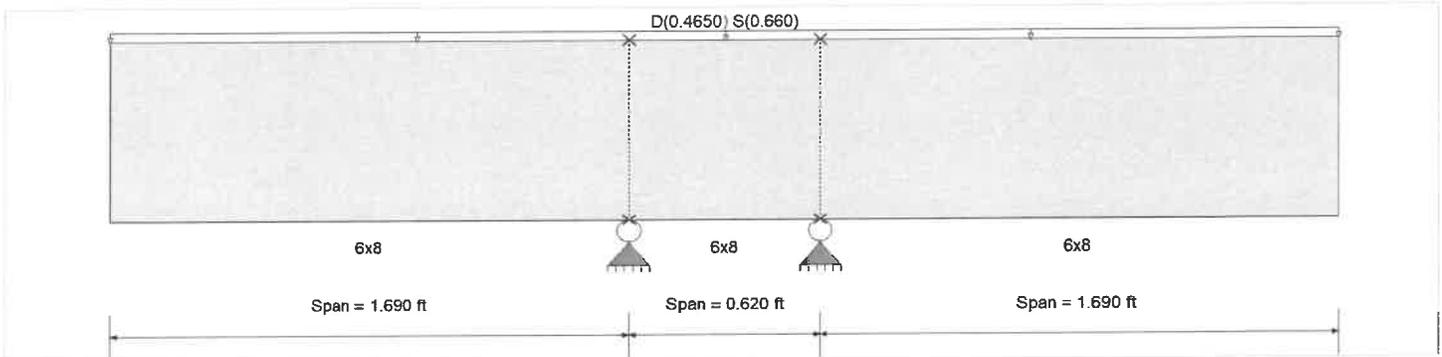

### Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added

Loads on all spans...

Uniform Load on ALL spans : D = 0.4650, S = 0.660 k/ft

### DESIGN SUMMARY

Maximum Bending Stress Ratio	=	0.771 : 1	Maximum Shear Stress Ratio	=	0.271 : 1
Section used for this span		6x8	Section used for this span		6x8
fb: Actual	=	509.85 psi	fv: Actual	=	43.64 psi
F'b	=	661.25 psi	F'v	=	161.00 psi
Load Combination		+D+S	Load Combination		+D+S
Location of maximum on span	=	1.690ft	Location of maximum on span	=	1.067 ft
Span # where maximum occurs	=	Span # 1	Span # where maximum occurs	=	Span # 1
Maximum Deflection					
Max Downward Transient Deflection	0.017 in	Ratio = 2318 >= 360	Span: 3 : S Only		
Max Upward Transient Deflection	0 in	Ratio = 0 < 360	n/a		
Max Downward Total Deflection	0.030 in	Ratio = 1358 >= 240	Span: 3 : +D+S		
Max Upward Total Deflection	-0.001 in	Ratio = 6490 >= 240	Span: 2 : +D+S		

### Vertical Reactions

Support notation : Far left is #1

Values in KIPS

Load Combination	Support 1	Support 2	Support 3	Support 4
Max Upward from all Load Conditions		2.250	2.250	
Max Upward from Load Combinations		2.250	2.250	
Max Upward from Load Cases		1.320	1.320	
D Only		0.930	0.930	
+D+S		2.250	2.250	
+D+0.750S		1.920	1.920	
+0.60D		0.558	0.558	
S Only		1.320	1.320	

## Wood Beam

Project File: 2023-LU 2514-2515 2021 IBC Struct Calcs.ec6

LIC# : KW-06013980, Build:20.23.05.22

MODERN BUILDING SYSTEMS

(c) ENERCALC INC 1983-2023

**DESCRIPTION:** CNTR COLUMN FTG - 2023-LU 2514-2515

### CODE REFERENCES

Calculations per NDS 2018, IBC 2021, ASCE 7-16

Load Combination Set : IBC 2021


### Material Properties

Analysis Method : Allowable Stress Design  
Load Combination : IBC 2021

Wood Species : Hem-Fir  
Wood Grade : No.2

Beam Bracing : Completely Unbraced

Fb +	850.0 psi	<i>E : Modulus of Elasticity</i>	
Fb -	850.0 psi	Ebend- xx	1,300.0ksi
Fc - Prll	1,300.0 psi	Eminbend - xx	470.0ksi
Fc - Perp	405.0 psi		
Fv	150.0 psi		
Ft	525.0 psi	Density	26.840pcf
		Repetitive Member Stress Increase	

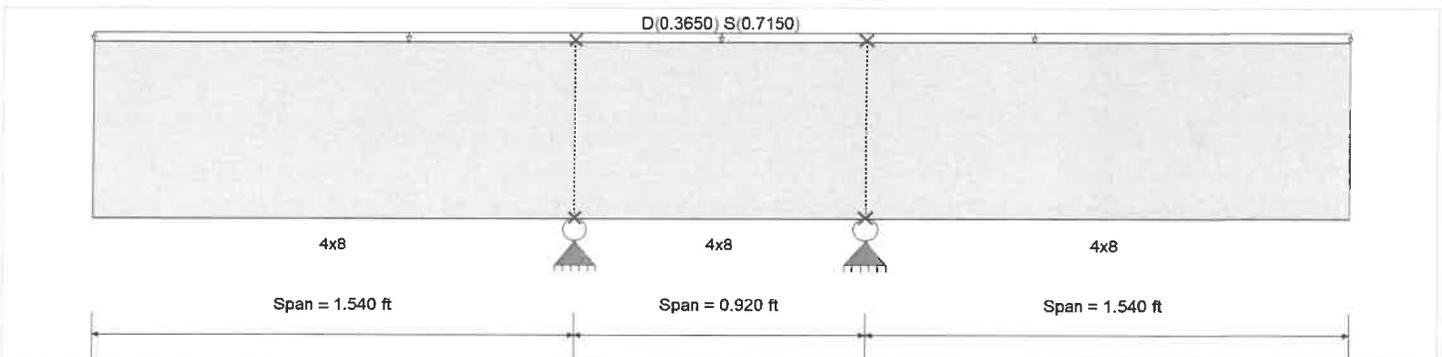

### Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added

Loads on all spans...

Uniform Load on ALL spans : D = 0.3650, S = 0.7150 k/ft

### DESIGN SUMMARY

				Design OK			
Maximum Bending Stress Ratio	=	<b>0.846</b>	1	Maximum Shear Stress Ratio	=	<b>0.434</b>	: 1
Section used for this span		<b>4x8</b>		Section used for this span		<b>4x8</b>	
fb: Actual	=	1,038.23psi		fv: Actual	=	59.87 psi	
F'b	=	1,227.54psi		F'v	=	138.00 psi	
Load Combination		+D+S		Load Combination		+D+S	
Location of maximum on span	=	1.540ft		Location of maximum on span	=	0.938 ft	
Span # where maximum occurs	=	Span # 1		Span # where maximum occurs	=	Span # 1	
<b>Maximum Deflection</b>							
Max Downward Transient Deflection		0.058 in	Ratio = 638 >= 360	Span: 3 : S Only			
Max Upward Transient Deflection		-0.005 in	Ratio = 2433 >= 360	Span: 2 : S Only			
Max Downward Total Deflection		0.087 in	Ratio = 422 >= 240	Span: 3 : +D+S			
Max Upward Total Deflection		-0.007 in	Ratio = 1611 >= 240	Span: 2 : +D+S			

### Vertical Reactions

Support notation : Far left is #1

Values in KIPS

Load Combination	Support 1	Support 2	Support 3	Support 4
Max Upward from all Load Conditions		2.160	2.160	
Max Upward from Load Combinations		2.160	2.160	
Max Upward from Load Cases		1.430	1.430	
D Only		0.730	0.730	
+D+S		2.160	2.160	
+D+0.750S		1.803	1.803	
+0.60D		0.438	0.438	
S Only		1.430	1.430	

## Wood Beam

Project File: 2023-LU 2514-2515 2021 IBC Struct Calcs.ec6

LIC#: KW-06013980, Build:20.23.05.22

MODERN BUILDING SYSTEMS

(c) ENERCALC INC 1983-2023

**DESCRIPTION:** CNTR COLUMN FTG INTERMEDIATE POST- 2023-LU 2514-2515

### CODE REFERENCES

Calculations per NDS 2018, IBC 2021, ASCE 7-16

Load Combination Set : IBC 2021


### Material Properties

Analysis Method : Allowable Stress Design  
Load Combination IBC 2021

Fb +	875.0 psi	<i>E</i> : Modulus of Elasticity	
Fb -	875.0 psi	Ebend- xx	1,300.0ksi
Fc - Prll	600.0 psi	Eminbend - xx	470.0ksi
Fc - Perp	625.0 psi		
Fv	170.0 psi		
Ft	425.0 psi	Density	31.210pcf

Wood Species : Douglas Fir - Larch  
Wood Grade : No.2

Beam Bracing : Completely Unbraced

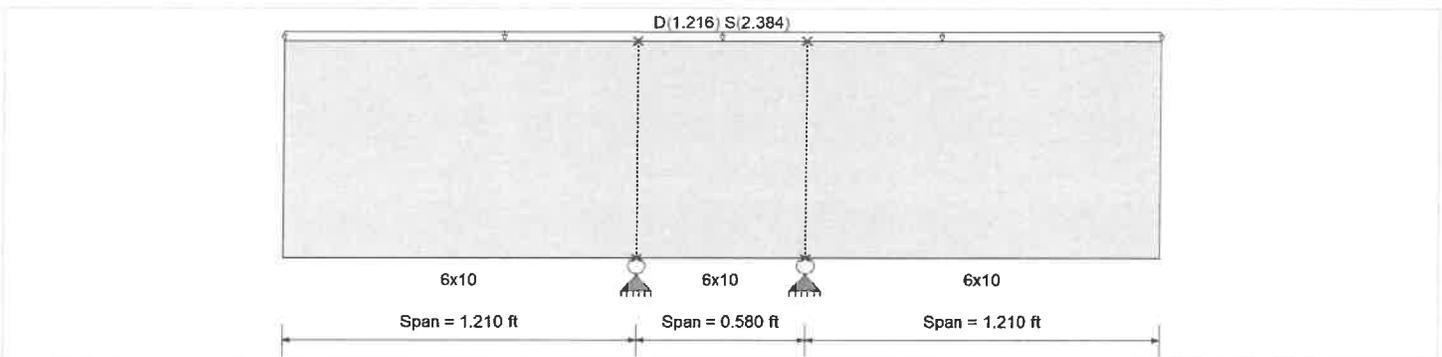

### Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added

Loads on all spans...

Uniform Load on ALL spans : D = 1.216, S = 2.384 k/ft

### DESIGN SUMMARY

**Design OK**

Maximum Bending Stress Ratio	=	<b>0.380</b> : 1	Maximum Shear Stress Ratio	=	<b>0.422</b> : 1
Section used for this span		<b>6x10</b>	Section used for this span		<b>6x10</b>
fb: Actual	=	382.27psi	fv: Actual	=	82.44 psi
F'b	=	1,005.39psi	F'v	=	195.50 psi
Load Combination		+D+S	Load Combination		+D+S
Location of maximum on span	=	1.210ft	Location of maximum on span	=	0.798 ft
Span # where maximum occurs	=	Span # 1	Span # where maximum occurs	=	Span # 1
<b>Maximum Deflection</b>					
Max Downward Transient Deflection	0.004 in	Ratio = 6978 >=360	Span: 3 : S Only		
Max Upward Transient Deflection	0 in	Ratio = 0 <360	n/a		
Max Downward Total Deflection	0.006 in	Ratio = 4620 >=240	Span: 3 : +D+S		
Max Upward Total Deflection	-0.000 in	Ratio = 19282 >=240	Span: 2 : +D+S		

### Vertical Reactions

Support notation : Far left is #1

Values in KIPS

Load Combination	Support 1	Support 2	Support 3	Support 4
Max Upward from all Load Conditions		5.400	5.400	
Max Upward from Load Combinations		5.400	5.400	
Max Upward from Load Cases		3.576	3.576	
D Only		1.824	1.824	
+D+S		5.400	5.400	
+D+0.750S		4.506	4.506	
+0.60D		1.094	1.094	
S Only		3.576	3.576	

## Wood Beam

Project File: 2023-LU 2514-2515 2021 IBC Struct Calcs.ec6

LIC#: KW-06013980, Build:20.23.05.22

MODERN BUILDING SYSTEMS

(c) ENERCALC INC 1983-2023

**DESCRIPTION:** (2) LVL RIDGE BEAM - 2023-LU 2514-2515

### CODE REFERENCES

Calculations per NDS 2018, IBC 2021, ASCE 7-16

Load Combination Set : IBC 2021

### Material Properties

Analysis Method : Allowable Stress Design  
Load Combination : IBC 2021

Wood Species : Murphy LVL 3100Fb-2.0E x 24" Deep  
Wood Grade : Manufactured


Beam Bracing : Beam bracing is defined as a set spacing over all spans

Fb +	2,736.0 psi	E : Modulus of Elasticity	
Fb -	2,736.0 psi	Ebend- xx	2,000.0ksi
Fc - Prll	3,200.0 psi	Eminbend - xx	1,800.0ksi
Fc - Perp	750.0 psi		
Fv	290.0 psi		
Ft	2,100.0 psi	Density	35.0pcf

### Unbraced Lengths

First Brace starts at ft from Left-Most support

Regular spacing of lateral supports on length of beam = 4.0 ft

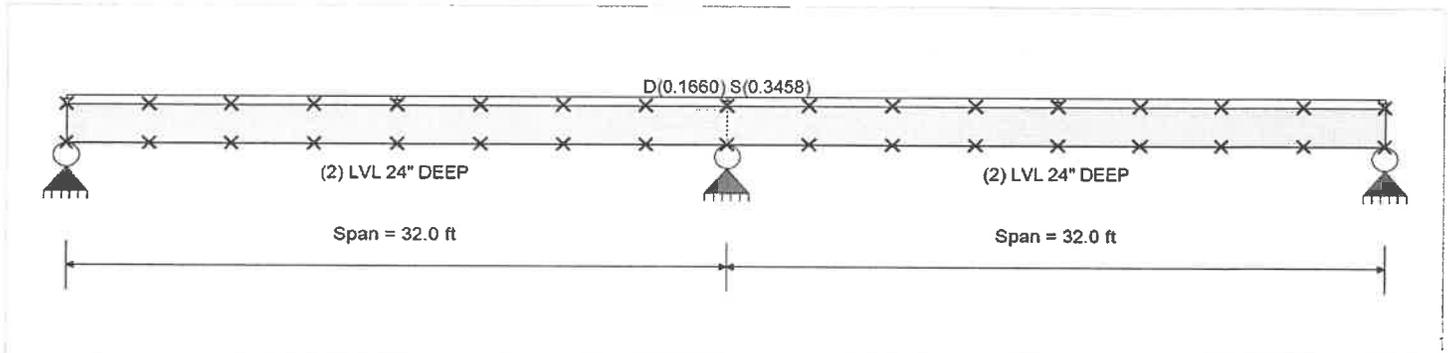

### Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added

Loads on all spans...

Uniform Load on ALL spans : D = 0.0120, S = 0.0250 ksf, Tributary Width = 13.830 ft

### DESIGN SUMMARY

				Design OK			
Maximum Bending Stress Ratio	=	0.894	1	Maximum Shear Stress Ratio	=	0.576	: 1
Section used for this span		(2) LVL 24" DEEP		Section used for this span		(2) LVL 24" DEEP	
fb: Actual	=	2,729.12	psi	fv: Actual	=	192.25	psi
F'b	=	3,051.71	psi	F'v	=	333.50	psi
Load Combination		+D+S		Load Combination		+D+S	
Location of maximum on span	=	32.000	ft	Location of maximum on span	=	30.034	ft
Span # where maximum occurs	=	Span # 1		Span # where maximum occurs	=	Span # 1	
Maximum Deflection							
Max Downward Transient Deflection		0.496	in Ratio =	773	>=	360	Span: 2 : S Only
Max Upward Transient Deflection		0	in Ratio =	0	<	360	n/a
Max Downward Total Deflection		0.734	in Ratio =	522	>=	240	Span: 2 : +D+S
Max Upward Total Deflection		0	in Ratio =	0	<	240	n/a

### Vertical Reactions

Support notation : Far left is #1

Values in KIPS

Load Combination	Support 1	Support 2	Support 3
Max Upward from all Load Conditions	6.141	20.468	6.141
Max Upward from Load Combinations	6.141	20.468	6.141
Max Upward from Load Cases	4.149	13.830	4.149
D Only	1.992	6.638	1.992
+D+S	6.141	20.468	6.141
+D+0.750S	5.103	17.011	5.103
+0.60D	1.195	3.983	1.195
S Only	4.149	13.830	4.149

} RXTS ONLY



PO Box 110 • 9493 Porter Rd • Aumsville, OR 97325  
**800.682.1422** ModernBuildingSystems.com

<b>JOB #</b>	2023-LU 2514-2515 Puyallup SD		
<b>SHEET NO</b>	L-1	OF	L-6
<b>CALCULATED BY</b>	MCL	<b>DATE</b>	5/30/2023
<b>CHECKED BY</b>	DATE		
<b>SCALE</b>			

**WIND ANALYSIS FOR ENCLOSED SIMPLE DIAPHRAGM LOW-RISE BUILDINGS - BASED ON IBC 2021 / ASCE 7-16 CHAPTER 28, PART 2**

**INPUT DATA**

Risk Category =	RC	II		(Table 1.5-1)
Basic Wind Speed =	Vult	120	Vasd =93	mph (3 sec gust)(Fig 26.5-1)
Exposure Category =	EC	B		(Sec. 26.7)
Topographic Factor =	Kzt	1.00		(Sec. 26.8 & 26.8-1)
Adjustment Factor =	Lambda	1.00		(Sec 28.6-1)
Building Length =	L	64.00	ft	
Building width =	B	27.67	ft	8:23:07 AM
Building Height to Eave =	he	11.00	ft	
Building Height to Ridge =	hr	15.00	ft	
Eave Overhang	oh	0.50	ft	
Building End Zone =	a	3.00	ft	
Roof Pitch =	RP	2.0	:12	
Approx. Roof Angle =	RA	10	degrees	(Ref. Fig. 28.6-1)

**OUTPUT**

**Wind Pressure, ps30 (Fig. 28.6-1)**

Horizontal	A-ps30	25.80	psf
Horizontal	B-ps30	-10.70	psf
Horizontal	C-ps30	17.10	psf
Horizontal	D-ps30	-6.20	psf
Vertical	E-ps30	-27.40	psf
Vertical	F-ps30	-16.80	psf
Vertical	G-ps30	-19.10	psf
Vertical	H-ps30	-12.90	psf
O.H.	Eoh-ps30	-38.40	psf
O.H.	Goh-ps30	-30.10	psf



PO Box 110 • 9493 Porter Rd • Aumsville, OR 97325  
**800.682.1422** ModernBuildingSystems.com

<b>JOB #</b>	<b>2023-LU 2514-2515 Puyallup SD</b>		
<b>SHEET NO</b>	L-2	OF	L-6
<b>CALCULATED BY</b>	MCL	<b>DATE</b>	5/30/2023
<b>CHECKED BY</b>		<b>DATE</b>	
<b>SCALE</b>			

**Wind Pressure, ps**

ps = Lambda \* Kzt \* ps30

				<b>Min Loading</b>
Horizontal	A-ps	25.80	psf	16.00
Horizontal	B-ps	-10.70	psf	8.00
Horizontal	C-ps	17.10	psf	16.00
Horizontal	D-ps	-6.20	psf	8.00
Vertical	E-ps	-27.40	psf	0.00
Vertical	F-ps	-16.80	psf	0.00
Vertical	G-ps	-19.10	psf	0.00
Vertical	H-ps	-12.90	psf	0.00
O.H.	Eoh-ps	-38.40	psf	
O.H.	Goh-ps	-30.10	psf	

**CASE A - Transverse Wind**

			<b>Min Loading</b>
	A-tw	1703 lbs	1056 lbs
Set to 0	B-tw	-257 lbs	192 lbs
	C-tw	10910 lbs	10208 lbs
Set to 0	D-tw	<u>-1438 lbs</u>	<u>1856 lbs</u>
<b>Total</b>		<u>12613 lbs (SD)</u>	<u>13312 lbs</u>
Convert to ASD x		0.6	0.6
<b>Total Force on building side L =</b>		<u><b>7568 lbs (ASD)</b></u>	<u><b>7987 lbs</b></u>

**CASE B - Longitudinal Wind**

	A-lw	890 lbs	552 lbs
	C-lw	<u>5587 lbs</u>	<u>5227 lbs</u>
<b>Total</b>		<u>6477 lbs (SD)</u>	<u>5779 lbs</u>
Convert to ASD x		0.6	0.6
<b>Total Force on building end B =</b>		<u><b>3886 lbs (ASD)</b></u>	<u><b>3468 lbs</b></u>

**CASE A - Transverse Uplift**

w/ gable end OH uplift	E-up	-2464 lbs
w/ gable end OH uplift	F-up	-1511 lbs
w/ gable end OH uplift	G-up	-15459 lbs
w/ gable end OH uplift	H-up	-10441 lbs
sidewall eaves OH uplift	Eoh-up	-166 lbs
sidewall eaves OH uplift	Goh-up	<u>-1247 lbs</u>
<b>Total</b>		<u><b>-31287 lbs (SD)</b></u>
Convert to ASD x		0.6
<b>Total Uplift Force =</b>		<u><b>-18772 lbs (ASD)</b></u>



PO Box 110 • 9493 Porter Rd • Aumsville, OR 97325  
 800.682.1422 ModernBuildingSystems.com

**JOB #2023-LU 2514-2515 Puyallup SD**

SHEET NO	L-3	OF	L-6
CALCULATED BY	MCL	DATE	5/30/2023
CHECKED BY		DATE	
SCALE			

**28' x 64' MODULAR**

**SEISMIC per IBC 2021 / ASCE 7-16, Sec. 12.8 Equivalent Lateral Force Procedure**

ASCE 7-16 Table 1.5-1	Risk Category		II
ASCE 7-16 Table 1.5-2	Seismic Importance Factor	Ie =	1.00
ASCE 7-16 Table 12.2-1	Response Modification Factor	R =	6.50
ASCE 7-16 11.4.3	Site Class		D
USGS Data	Short Spectral Response Accel.	Ss =	1.500
ASCE 7-16 Table 11.4-1 & Sec 11.4.4	Site Coefficient	Fa =	1.200
ASCE 7-16 Eqn. 11.4-1	Sms = Ss * Fa	Sms =	1.800
ASCE 7-16 Eqn 11.4-3	Sds = 2/3 * Sms	Sds =	1.200
ASCE 7-16 Sec. 12.8.1.3		Sds Max =	1.000
USGS Data	Long Spectral Response Accel.	S1 =	0.600
ASCE 7-16 Table 11.4-2	Site Coefficient	Fv =	1.700
ASCE 7-16 Eqn. 11.4-2	Sm1 = S1 * Fv	Sm1 =	1.020
ASCE 7-16 Eqn 11.4-4	Sd1 = 2/3 * Sm1	Sd1 =	0.680
Short Period Transition Sec 11.4.6	Ts = Sd1 / Sds	Ts =	0.680
Building Period Eqn. 12.8-7	Ta = Ct*hn^(x) = 0.02*13'^0.75	Ta =	0.137
ASCE 7-16 Sec. 11.4.8	Check Ta <= 1.5*Ts, 0.137 <= 1.02		OK
ASCE 7-16 Eqn. 12.8-2	Cs = Sds/(R/Ie) = 1.000/(6.50/1.00)	Cs =	0.154
ASCE 7-16 Eqn. 12.8-3	Csmax: Not checked (conservative)		
ASCE 7-16 Eqn. 12.8-5	Csmin = 0.044*Sds*Ie >= 0.01	Csmin =	0.044
ASCE 7-16 Eqn. 12.8-6	If S1 > 0.6 Csmin = 0.5*S1/(R/Ie)	Csmin =	N/A
ASCE 7-16 Table 11.6-1	Seismic Design Cat.		D
<b>Base Shear</b>			
ASCE 7-16 Eqn 12.8-1	V = Cs * W * 0.7	V =	0.108 W
ASCE 7-16 Eqn 12.8-5	V = Csmin * W * 0.7	Vmin =	0.031 W
IBC 2021 1605.3.1	Note: 0.7 converts to ASD		



PO Box 110 • 9493 Porter Rd • Aumsville, OR 97325  
 800.682.1422 ModernBuildingSystems.com

**JOB #2023-LU 2514-2515 Puyallup SD**

SHEET NO	L-4	OF	L-6
CALCULATED BY	MCL	DATE	5/30/2023
CHECKED BY		DATE	
SCALE			

**Building Weight Estimate**

	Roof (psf)		Exterior Wall (psf)
Comp	2.5	15/32 T1-11	1.7
7/16 Shtg	1.5	2x6 @ 16	1.7
2x10 @24	1.9	R-21U	1.3
R-42L	2.0	5/8 Gyp	2.8
Drp Grd	1.8		0
	0		0
	0		0
<b>Total</b>	<b>9.7</b>		<b>7.5</b>

	Interior Wall (psf)		Floor (psf)
5/8 Gyp	2.8	Misc	1.0
2x4 @ 16	1.1	23/32 Shtg	2.5
5/8 Gyp	2.8	2x8 @ 16	2.2
	0	R-30U	1.6
	0		0
	0		0
<b>Total</b>	<b>6.7</b>		<b>7.3</b>



PO Box 110 • 9493 Porter Rd • Aumsville, OR 97325  
**800.682.1422** ModernBuildingSystems.com

**JOB #2023-LU 2514-2515 Puyallup SD**

SHEET NO	L-5	OF	L-6
CALCULATED BY	MCL	DATE	5/30/2023
CHECKED BY		DATE	
SCALE			

**Building Weight (con't)**

No Snow	28.67'	65.00'	0.0 psf	=	0	lbs
Roof =	28.67'	65.00'	9.7 psf	=	18076	lbs
Ext. Wall =	8.00'	183.34'	7.5 psf	=	11000	lbs
Int. Wall =	8.00'	44.00'	6.7 psf	=	2358	lbs
Floor =	27.67'	64.00'	7.3 psf	=	12927	lbs
Chassis =				=	0	lbs
Solar =	28.67'	65.00'	0.0 psf	x 40% =	0	lbs

Enter 0 or 5

**Total**                      **Includes snow and solar, if any ->**                      **W=**                      **44363 lbs**

Wr = Total DL tributary to roof                      24756      lbs  
W1 = Total DL tributary to floor                      19607      lbs

Story	Height	Weight		Story Force - k $F_x = \frac{w_x \cdot h_x}{\sum w_x \cdot h_x} \cdot V$	Fx Coef = $\frac{V \cdot h_x}{\sum w_x \cdot h_x}$	Story Shear  (Vx)
	(hx)	(wx)	(wx*hx)			
R	11.00'	24.76 k	272 k-ft	<b>4.05 k</b>	0.164	4.05 k
1	2.50'	19.61 k	49 k-ft	<b>0.73 k</b>	0.037	4.78 k
Grade	0.00'					
<b>Sum (Σ)</b>		<b>44.36 k</b>	<b>321 k-ft</b>	<b>V= 4.78 k</b>	<b>= Base Shear</b>	

Shear Value Comparison	OK
------------------------	----

**⚠** This is a beta release of the new ATC Hazards by Location website. Please [contact us](#) with feedback.


**🔕** The ATC Hazards by Location website will not be updated to support ASCE 7-22. [Find out why.](#)

# ATC Hazards by Location

*L-6 of L-6*

## Search Information

**Address:** 105 7th Ave SW, Puyallup, WA 98371, USA  
**Coordinates:** 47.186201, -122.2937556  
**Elevation:** 39 ft  
**Timestamp:** 2023-05-30T14:59:11.361Z  
**Hazard Type:** Seismic  
**Reference Document:** ASCE7-16  
**Risk Category:** II  
**Site Class:** D-default

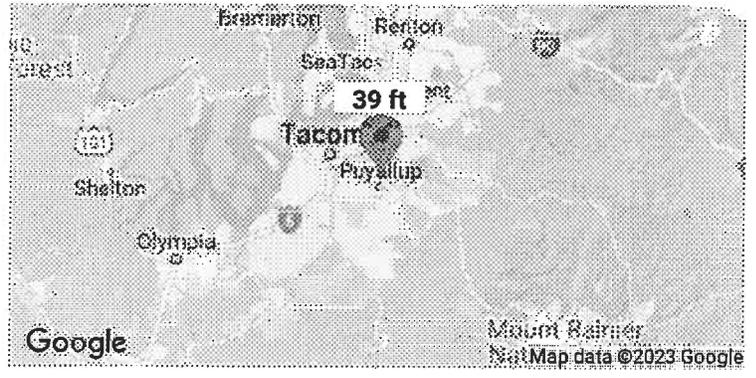

## Basic Parameters

Name	Value	Description
$S_S$	1.27	$MCE_R$ ground motion (period=0.2s)
$S_1$	0.437	$MCE_R$ ground motion (period=1.0s)
$S_{MS}$	1.524	Site-modified spectral acceleration value
$S_{M1}$	* null	Site-modified spectral acceleration value
$S_{DS}$	1.016	Numeric seismic design value at 0.2s SA
$S_{D1}$	* null	Numeric seismic design value at 1.0s SA

*$\leq 0.600 \therefore \underline{OK}$*

*= 1.000 PER ASCE 7-16 SEC 12.8-1.3*

\* See Section 11.4.8

## Additional Information

Name	Value	Description
SDC	* null	Seismic design category
$F_a$	1.2	Site amplification factor at 0.2s
$F_v$	* null	Site amplification factor at 1.0s
$CR_S$	0.914	Coefficient of risk (0.2s)
$CR_1$	0.898	Coefficient of risk (1.0s)
PGA	0.5	$MCE_G$ peak ground acceleration
$F_{PGA}$	1.2	Site amplification factor at PGA
$PGA_M$	0.6	Site modified peak ground acceleration

**ULTIMATE FRICTION FACTORS AND  
ADHESION FOR DISSIMILAR MATERIALS  
(NAVFAC DM 7.2, Table 1, p7.2-63)**

Interface Materials	Friction factor	Friction angle, degrees
<b>Mass concrete on the following foundation materials:</b>		
Clean sound rock	0.70	35
Clean gravel, gravel-sand mixtures, coarse sand	0.55 to 0.60	29 to 31
Clean fine to medium sand, silty medium to coarse sand, silty or clayey gravel	0.45 to 0.55	24 to 29
Clean fine sand, silty or clayey fine to medium sand	0.35 to .045	19 to 24
Fine sandy silt, non-plastic silt	0.30 to 0.35	17 to 19
Very stiff and hard residual or pre-consolidated clay	0.40 to 0.50	22 to 26
Medium stiff and stiff clay and silty clay	0.30 to 0.35	17 to 19
(Masonry on foundation materials has same friction factors.)		
<b>Steel sheet piles against the following soils:</b>		
Clean gravel, gravel-sand mixtures, well-graded rock fill with spalls	0.40	22
Clean sand, silty sand-gravel mixture, single size hard rock fill	0.30	17
Silty sand, gravel or sand mixed with silt or clay	0.25	14
Fine sandy silt, non-plastic silt	0.20	11
<b>Formed concrete or concrete sheet piling against the following soils:</b>		
Clean gravel, gravel-sand mixtures, well-graded rock fill with spalls	0.40 to 0.50	22 to 26
Clean sand, silty sand-gravel mixture, single size hard rock fill	0.30 to 0.40	17 to 22
Silty sand, gravel or sand mixed with silt or clay	0.30	17
Fine sandy silt, non-plastic silt	0.25	14
<b>Various structural materials:</b>		
Masonry on masonry, igneous and metamorphic rocks:		
Dressed soft rock on dressed soft rock	0.70	35
Dressed hard rock on dressed soft rock	0.65	33
Dressed hard rock on dressed hard rock	0.55	29
Masonry on wood (cross grain)	0.50	26
Steel on steel at sheet pile interlocks	0.30	17
<b>Interface Materials (Cohesion)</b>	<b>Adhesion C<sub>a</sub> (psf)</b>	
Very soft cohesive soil (0 - 250 psf)	0 - 250	
Soft cohesive soil (250 - 500 psf)	250 - 500	
Medium stiff cohesive soil (500 - 1000 psf)	500 - 750	
Stiff cohesive soil (1000 - 2000 psf)	750 - 950	
Very stiff cohesive soil (2000 - 4000 psf)	950 - 1,300	

Continental Supply NW, LLC

# TIE DOWNS

ENGINEERED TIE DOWN SYSTEM

## GENERAL NOTES

**DESIGN LOADS:**

- \* WIND ----- COMPLIES WITH 2018 IBC Vult = 115 MPH Exp C
- \* SOIL BEARING ----- 1000 PSF
- \* TIE DOWN STRAP ----- 3160# WORKING LOAD
- \* SEISMIC ZONE ----- 2018 IBC  $S_e=1.5$   $F_a=1.4$   $S_{ms}=1.41$  Site Class D
- \* TIE DOWN STRAPS TO BE MIN. 1 1/4" WIDE x 0.035 THICKNESS ZINC PLATED AND MEET ASTM D-3953-97 ALT. STRAP; 1 1/4" WIDE X 0.029" THICK ZINC PLATED  $F_{ult}' = 5400$  LBS
- \* EARTH AUGERS ----- 2962 # (TESTED TO 4750# MIN.)
- \* CROSS DRIVES ----- 2962 # (TESTED TO 4750# MIN.)
- \* CONCRETE SLAB ANCHORS ----- 2962 # (CALCULATE#)

1. THE CHARTS SHOW THE REQUIRED NUMBER OF TIE DOWNS ON THE SIDES AND ENDS OF THE MANUFACTURED HOME.
2. COMBINATIONS OF THE DIFFERENT TYPES OF TIE DOWNS CAN BE USED.
3. FOR ALL TIE DOWN INSTALLATIONS, THE MANUFACTURED HOME CHASSIS MEMBERS ARE SHOWN AS "I" BEAMS, (FOR ILLUSTRATION PURPOSE ONLY) CHASSIS BEAMS
4. SIDE TIE DOWNS ARE REQUIRED ALONG THE OUTSIDE CHASSIS BEAMS. END TIE DOWNS ARE REQUIRED AT EACH END OF EACH TRANSPORTABLE SECTION OF THE MANUFACTURED HOME.
5. END TIE DOWNS CAN BE LOCATED WITHIN 18" OF EITHER SIDE OF CHASSIS BEAM



6. THE SIZES, TYPES, LENGTHS, ECT, OF MATERIALS SHOWN HEREON ARE MINIMUM, LARGER, LONGER, HEAVIER MATERIALS SUPPLIED BY SAC INDUSTRIES, INC. MAY BE USED AT THE SAME SPACING AND LOCATION SHOWN.
7. ALL PARTS ARE COATED WITH RUST RESISTANT INDUSTRIAL SHOP PRIMER

## STATE APPROVAL

Continental Supply NW, LLC  
 1570 Bishop Road  
 Chehalis, WA 98532  
 888-265-8981

CA


PACIFIC CONSULTING ENGINEERS  
 9739 North Vista Drive  
 Kingman, AZ 86401  
 PH 916-296-7376

ENGINEERS APPROVAL

OR



WA

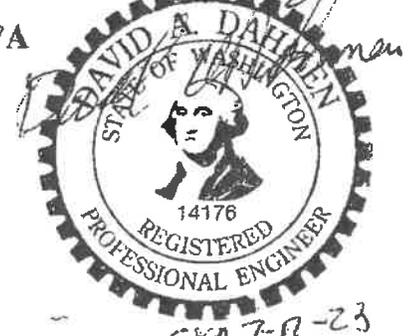

ID




UT

AZ

NV

# STABIL-X DRIVE TIE DOWN ANCHORS

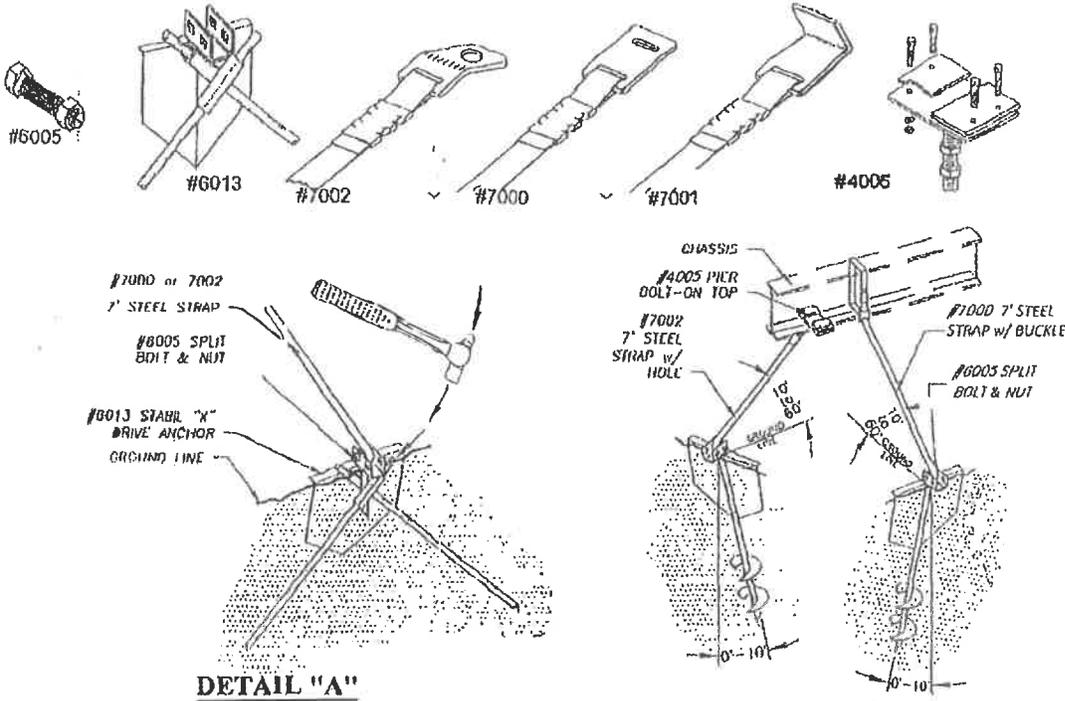

**STABIL-X DRIVE TIE DOWN  
SEE DETAIL "A"**

## INSTALLATION INSTRUCTIONS

1. **CONTRACTORS WARNING:** CHECK FIRST FOR UNDERGROUND UTILITIES.
2. DRIVE STABILIZER PLATE INTO GROUND.
3. DRIVE CROSS RODS THROUGH HEAD TUBES INTO SOIL AS SHOWN.
4. ATTACH STRAPS TO CHASSIS BEAM IN MANNER SHOWN.
5. IF ANGLE OF SIDE STRAP IS GREATER THEN 60°, STRAP CONNECTION CAN BE MADE FROM ANCHOR TO OPPOSITE CHASSIS BEAM.
6. INSERT STRAP THROUGH SPLIT BOLT. CUT OFF EXCESS STRAP AND TIGHTEN BOLT UNTIL STRAP IS SNUG.
7. #6011 ANCHOR CAN BE USED WHERE HARD OR ROCKY SOIL OCCURS. IF THE GROUND SURFACE IS OTHER THAN ROCKY SOIL OR MINIMUM 2" ASPHALT, USE STABIL-X ANCHOR OR ENCASE ANCHOR WITH 12"x12"x12" CUBE OF CONCRETE.
8. WHEN #6011 ANCHOR IS USED FOR ANY REQUIRED ANCHOR - (2) ANCHORS MUST BE USED AT THAT LOCATION.



EARTH AUGERS				CROSS DRIVE ANCHORS				CONCRETE SLAB ANCHORS			
MAX. LENGTH OF MFO'D HOME	36'	64'	72'	MAX. LENGTH OF MFO'D HOME	36'	64'	72'	MAX. LENGTH OF MFO'D HOME	36'	64'	72'
MIN. NO. OF SIDE TIE DOWNS	2	3	4	MIN. NO. OF SIDE TIE DOWNS	2	3	4	MIN. NO. OF SIDE TIE DOWNS	2	3	4


### NOTE:

SIDE TIE-DOWNS: MUST BE WITHIN 24" OF THE END OF THE CHASSIS BEAM.

END TIE-DOWNS: CAN BE LOCATED WITHIN 24" OF EITHER SIDE OF CHASSIS BEAM ONE TIE-DOWN IS MANDATORY AT EACH END OF "I" BEAM (SEE PAGE #1 GENERAL NOTE #5).

IF SIDE WALL TIE-DOWN GROUND ANCHOR LOCATION IS SUCH THAT THE ANGLE BETWEEN THE GROUND AND STRAP EXCEEDS 60°, CONNECT THE TIE STRAP TO THE INSIDE CHASSIS BEAM ON DOUBLE AND TRIPLE WIDES AND THE OPPOSITE CHASSIS BEAM ON SINGLE WIDES.

## CONCRETE TIE DOWN ANCHORS

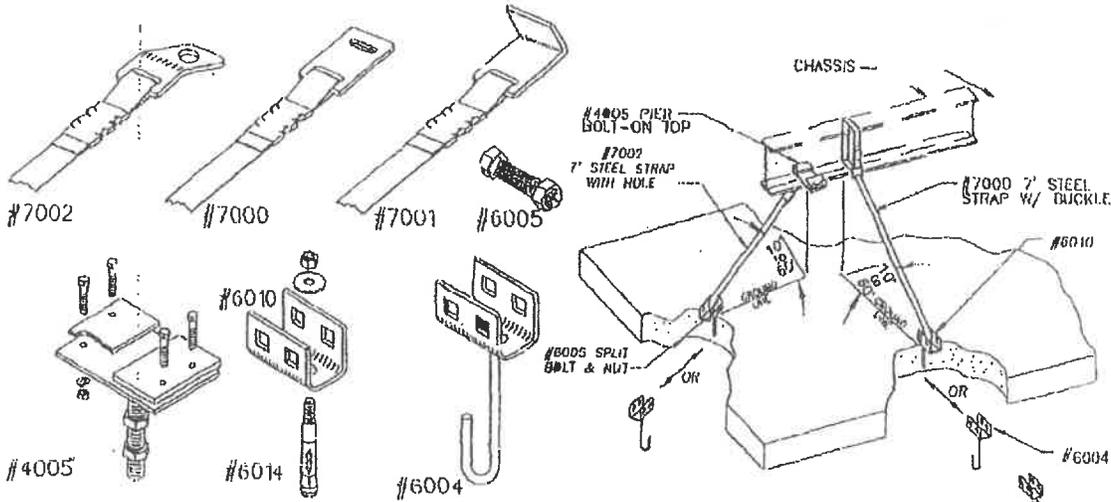

### CONCRETE TIE-DOWN

### INSTALLATION INSTRUCTIONS

### ALTERNATE CONNECTION

#### NEW CONCRETE - #6004

1. PLACE CONCRETE ANCHOR INTO WET CONCRETE, AND ALLOW TO PROPERLY CURE.
2. ALTERNATE CONNECTION REQUIRES #5 REBAR PROPERLY EMBEDDED IN CONCRETE.

#### EXISTING CONCRETE - #6010



1. CONCRETE MUST BE A MINIMUM 3 1/2" THICK AND IN GOOD CONDITION.
2. MINIMUM SLAB AREA OF EACH ANCHOR IS 28 SQUARE FEET.
3. DRILL PROPER SIZE HOLE IN SLAB, A MINIMUM OF 12" FROM ANY SIDE.
4. EXPANSION BOLT IS 5/8" x 3 1/2" WITH MINIMUM 2 3/4" EMBEDMENT AND 6,180 POUNDS PULL OUT, 7,180 POUNDS SHEAR.

#### CHASSIS CONNECTION

1. ATTACH STRAPS TO CHASSIS BEAM IN MANNER SHOWN.
2. IF ANGLE OF SIDE STRAP IS GREATER THAN 60°, STRAP CONNECTION CAN BE MADE FROM ANCHOR TO OPPOSITE CHASSIS BEAM.
3. INSERT STRAP THROUGH SPLIT BOLT, CUT OFF EXCESS STRAP AND TIGHTEN BOLT UNTIL STRAP IS SNUG.

NOTE: SIDE TIE DOWNS ARE REQUIRED ALONG THE OUTSIDE CHASSIS BEAMS. END TIE DOWNS ARE REQUIRED AT EACH END OF EACH TRANSPORTABLE SECTION OF THE MANUFACTURED HOME.

NOTE: A COMBINATION OF DIFFERENT TYPES OF TIE DOWNS CAN BE USED.

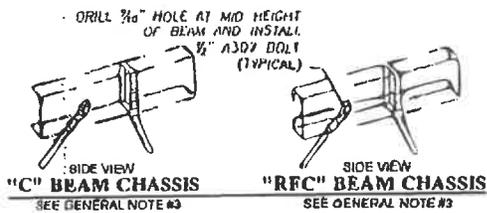

NOTE: END TIE DOWN CAN BE LOCATED WITHIN 18" OF EITHER SIDE OF CHASSIS BEAM AXIS.

### CONTRACTORS CERTIFICATION

I CERTIFY THAT I HAVE INSTALLED THE ANCHORING SYSTEM AS PER THE INSTALLATION INSTRUCTIONS. I HAVE MADE NO MODIFICATIONS TO THE ANCHORING SYSTEM OR THE BUILDING STRUCTURE.

COMPANY NAME: \_\_\_\_\_ CONTRACTORS LIC. # \_\_\_\_\_

# PGM Inc.

Soil Class	Soil Description	Test Probe Values (in lbs.)	Recommended PGM Part	PGM part description
<b>1</b>	Hard Rock or Rocky	N/A	# 6011 or # 6002	Cross Drive Anchor W/ 30" Rods Cross Drive Anchor W/ 30" Rods
	Very Dense and or Cemented Sands, Coarse Gravel, Cobbles and Clays	550+	# 6000 # 6006 # 6013	30" Auger Anchor W/2 4" Helix 12" Stabilizer Plate Stabil X - Drive
<b>3</b>	Medium Dense Coarse Sands, Sandy Gravels, Very Very Stiff Silts & Clays	351 to 550	Available Upon Request	
	Loose to Medium Dense Sands, Firm to Stiff Clays & Silts, Alluvial Fill	276 to 350	Available Upon Request	
<b>4b</b>	Very Loose Sands, Firm Clays & Silts Alluvial Fill	175 to 275	Available Upon Request	

Please Note : Each State, County or Municipality may require a specific anchor from the groups shown above for each soil classification.  
Check local and stata regulations first.



CONTINENTAL SUPPLY NW, LLC  
**STEEL PIERS**

ADJUSTABLE STEEL PIERS & TOPS

GENERAL NOTES

DESIGN LOADS:

- \* STEEL PIERS ----- 6,000 LB. RATED LOAD CAPACITY  
 18,000 LB. MINIMUM TESTED LOAD CAPACITY
- \* STEEL PIERS SHALL BE COATED WITH RUST RESISTANT COATING AND SHALL  
 BE LISTED AND LABELED FOR THE FOLLOWING LOAD:  
 VERTICAL=6,000 POUNDS MAXIMUM

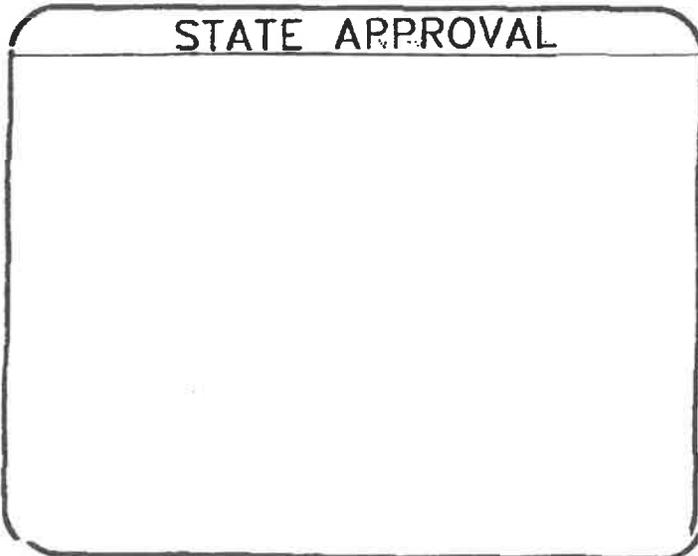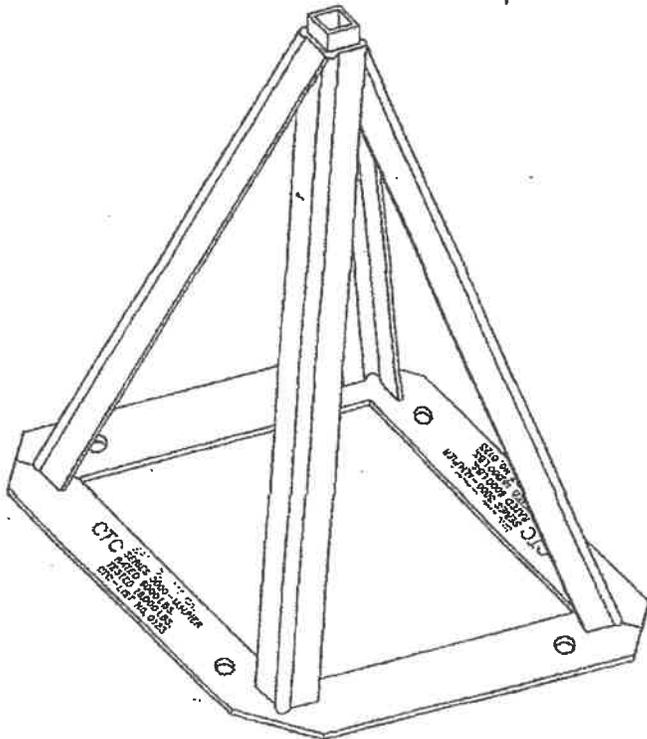

Continental Supply NW, LLC  
 1570 Bishop Road  
 Chehalis, WA 98532  
 888-265-8981


PACIFIC CONSULTING ENGINEERS  
 9739 North Vista Drive  
 Kingman, AZ 86401  
 PH 916-296-7376

ENGINEER APPROVAL




# ADJUSTABLE STEEL PIERS

## CHASSIS BEAM SUPPORT (TYPICAL)

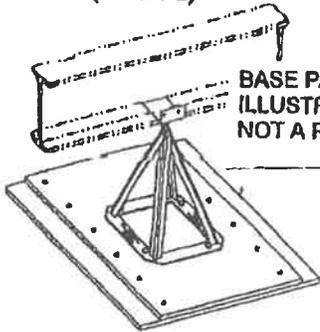

BASE PADS ARE SHOWN FOR ILLUSTRATION ONLY AND ARE NOT A PART OF THE PIER APPROVAL

## MATING LINE SUPPORT (TYPICAL)

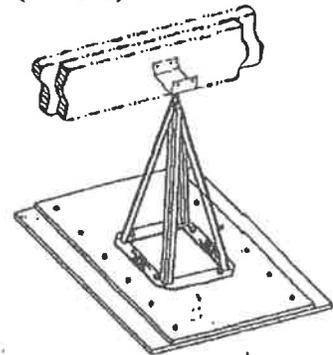

NOTE:  
IF PIER IS NOT CAPABLE OF REACHING RIDGE DEAM, USE 4" x 6" WOOD POST.

## INSTALLATION INSTRUCTIONS

1. PREPARE A LEVEL SURFACE AT THE LOCATION OF EACH PIER TO INSURE A FULL CONTACT FOR THE FOOTING PAD. USE THE APPROPRIATE SIZE PAD FOR THE LOAD REQUIRED. REFER TO THE MANUFACTURERS SET UP MANUAL FOR SPECIFIC LOADS AND FOOTING SIZES.
2. SELECT THE APPROPRIATE SIZE PIERS FOR THE INSTALLATION BY DETERMINING THE PIER HEIGHT AT EACH SUPPORT LOCATION. MEASURE FROM THE TOP OF THE PAD TO THE BOTTOM OF THE CHASSIS BEAM TO INSURE THAT HEIGHT IS NO GREATER THAN 32".
3. SELECT THE APPROPRIATE TOP FOR THE CHASSIS BEAM OR MATING LINE. THE MAXIMUM ADJUSTMENT ON THE THREADED ROD ADJUSTER FOR CHASSIS BEAM SUPPORT IS 2". WHEN MORE HEIGHT IS NEEDED USE THE NEXT TALLER SIZE SUPPORT PIER.
4. PLACE THE PIER SUPPORT IN THE CENTER OF THE SUPPORT PAD. WHERE REQUIRED BY LOCAL CODE, ATTATCH THE SUPPORT PIER TO THE PAD USING APPROPRIATE FASTENERS. CAREFULLY ALIGN THE SUPPORT PIER AND TOP UNDER THE CHASSIS BEAM OR MATING LINE AND TIGHTEN UNTIL SNUG PLUS 1/2 TURN.
5. REPEAT THIS INSTALLATION PROCEDURE WITH EACH SUPPORT PIER. AFTER ALL THE SUPPORT PIERS HAVE BEEN INSTALLED, AND THE HOME SET UP HAS BEEN COMPLETED PER THE MANUFACTURERS SET UP INSTRUCTIONS, YOU MAY THEN REMOVE THE SAFTEY BLOCKING OF OTHER DEVICES USED TO LEVEL THE CHASSIS.


## LABORATORY TESTING REPORT

<u>PART No.</u>	<u>STAND SIZE</u>	<u>SAMPLE #1</u>	<u>SAMPLE #2</u>	<u>SAMPLE #3</u>
3008	8"	23,100 Lbs.	24,600 Lbs.	23,200 Lbs.
3010	10"	25,130 Lbs.	25,950 Lbs.	24,320 Lbs.
3012	12"	27,200 Lbs.	26,500 Lbs.	26,300 Lbs.
3014	14"	27,700 Lbs.	28,175 Lbs.	26,175 Lbs.
3016	16"	28,250 Lbs.	27,700 Lbs.	23,400 Lbs.
3018	18"	26,400 Lbs.	33,300 Lbs.	25,500 Lbs.
3020	20"	24,950 Lbs.	25,000 Lbs.	23,225 Lbs.
3022	22"	20,500 Lbs.	22,400 Lbs.	24,200 Lbs.
3024	24"	22,225 Lbs.	21,650 Lbs.	23,000 Lbs.
3026	26"	22,250 Lbs.	21,500 Lbs.	19,700 Lbs.
3028	28"	20,550 Lbs.	23,720 Lbs.	21,310 Lbs.
3030	30"	22,950 Lbs.	26,550 Lbs.	21,500 Lbs.

## PIER IDENTIFICATION STAMP

PGM Inc.  
SERIES 3000-M H PIER  
RATED 6,000 LBS.  
TESTED 18,000 LBS  
C.T.C. LIST NO. 0123

# ADJUSTABLE STEEL TOPS




**BOLT ON TOP**  
#4005



**SCREW ON TOP**  
#4006



**"L" TOP**  
#4003




**5" SADDLE TOP**  
#4002




**5" LOCK TOP SLIDER**  
#4004

## INSTALLATION INSTRUCTIONS

- #4002 - PLACE SADDLE TOP FLUSH AGAINST MAIN CHASSIS BEAM AND OR MATING LINE - MAXIMUM HEIGHT ADJUSTMENT OF TOP IS 2".
- #4004 - 5" LOCK TOP SLIDER ATTACH BOLT ON TOP TO "I" BEAM WITH (2) 3/8" BOLTS AND NUTS - WITH 2ND 3/4" NUT, ATTACH BOLT ON TOP TO PIER - MAXIMUM HEIGHT ADJUSTMENT OF TOP IS 2".
- #4005 - ATTACH BOLT ON TOP TO "I" BEAM WITH (4) 3/8" BOLTS AND NUTS - WITH 2ND 3/4" NUT, ATTACH BOLT ON TOP TO PIER - MAXIMUM HEIGHT ADJUSTMENT OF TOP IS 2".
- #4003 - PLACE "L" TOP FLUSH AGAINST MAIN BEAM - ALTERNATE "L" TOP DIRECTION EVERY OTHER PIER - MAXIMUM HEIGHT ADJUSTMENT OF TOP IS 2".
- #4006 - ATTACH SCREW ON TOP TO MAIN CHASSIS BEAM WITH (4) #12 SMS TEK SCREWS. WHEN USED AT MATING LINE, ATTACH WITH NAILS OR SCREWS. MAXIMUM HEIGHT ADJUSTMENT OF TOP IS 2".

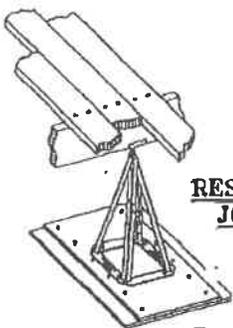

**RESIDENTIAL FLOOR**  
**JOINT SUPPORT**




**DECK**  
**SUPPORT**

BASE PADS ARE SHOWN FOR ILLUSTRATION ONLY AND ARE NOT A PART OF THE PIER APPROVAL

# CONTINENTAL SUPPLY NW LLC SYSTEM SET (TYPICAL)




**BOLT-ON TOP**



**STEEL PIER  
(6,000 LB RATED)**

**NOTES**

CHECK MANUFACTURED HOME SET UP INSTRUCTIONS FOR LOADS AND LOCATIONS.

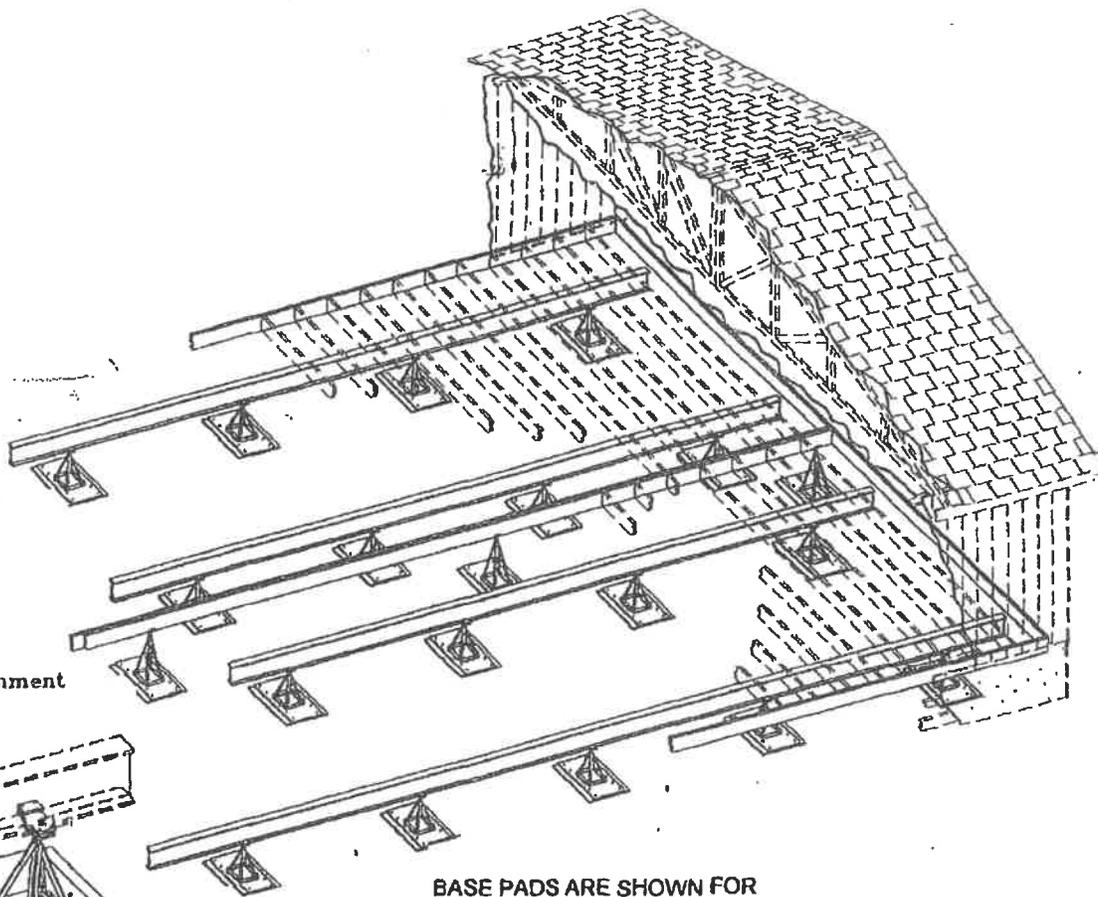


• **STATE APPROVED**  
Tested-Listed-Labeled  
Stamped in Base Plate


• **6,000 LB. RATED**  
3-1 Safety Factor

• **HOLES PRE-PUNCHED**  
In base for easy attachment  
to pad or footing


BASE PADS ARE SHOWN FOR ILLUSTRATION ONLY AND ARE NOT A PART OF THE PIER APPROVAL



**CHASSIS BEAM SUPPORT**



**MATING LINE SUPPORT**

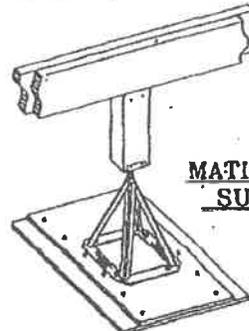

**MATING LINE SUPPORT**