

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building

Planning

Engineering

Public Works

Fire

Traffic

PRMU20240405

ENGINEERING ANALYSIS FOR:
EAST TOWN CROSSING
APARTMENTS
PIONEER & SHAW
PUYALLUP, WA
BUILDING H



PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
3128 N. BENNETT ST.
TACOMA, WA 98407

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE IDEAS AND DESIGN
INCORPORATED HEREIN ARE THE PROPERTY OF
PIERUCCIONI E&C, LLC AND ARE NOT TO BE REUSED
OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE
WRITTEN AUTHORIZATION OF PIERUCCIONI E&C, LLC.

EAST TOWN CROSSING
BUILDING "H"
PIONEER & SHAW PUYALLUP WA

DESIGN CRITERIA

BUILDING CODE: 2018 INTERNATIONAL BUILDING CODE (IBC) AS AMENDED BY THE
LOCAL JURISDICTION.
VERTICAL LOADS
ROOF LIVE LOAD: 25 PSF (SNOW)
ROOF DEAD LOAD: 25 PSF
RESIDENTIAL FLOOR LIVE LOAD: 40 PSF (REDUCIBLE) : 60 PSF (FOR DECKS)
STAIRWAY LANDING AREAS: 150 PSF (INCLUDING $l_p=1.5$)
FLOOR DEAD LOAD: 30 PSF (INCLUDES $1\frac{1}{2}$ " GYP TOPPING)
SNOW DESIGN DATA (ASCE 7-16) WIND DESIGN DATA (ASCE 7-16)
FLAT SNOW LOAD: N/A BASIC WIND SPEED (ASD) $V=85$ MPH
SNOW EXPOSURE FACTOR, $C_e=1.0$, ULTIMATE WIND SPEED $V=110$ MPH
SNOW IMPORTANCE FACTOR, $I_s=1.0$, RISK CATEGORY: II EXPOSURE: B
THERMAL FACTOR, $C_t=1.1$ IMPORTANCE FACTOR, $I_w=1.0$
TOPOGRAPHIC FACTOR, $K_{zt}=1.0$

SEISMIC DESIGN DATA (ASCE7-16)
SEISMIC RESPONSE SYSTEM: WOOD SHEARWALLS
EQUIVALENT LATERAL FORCE PROCEDURE (ASCE 7-16)
RISK CATEGORY: II SEISMIC IMPORTANCE FACTOR, $I_e=1.0$
MAPPED SPECTRAL RESPONSE ACCELERATION: $S_s=1.24$, $S_1=0.476$
DESIGN SPECTRAL RESPONSE ACCELERATION: $S_{ds}=0.831$, $S_{d1}=0.476$
SITE CLASS: D SEISMIC DESIGN CATEGORY: D
SEISMIC RESPONSE COEFFICIENT: $C_s=0.091$
DESIGN BASE SHEAR: 82,321#
SOIL PROPERTIES:
BEARING CAPACITY: 2,000 PSF
LATERAL CAPACITY: 250 PSF/FT

Calculations required to be provided by
the Permittee on site for all Inspections

City of Puyallup
Building
REVIEWED
FOR
COMPLIANCE

BSnowden
05/13/2024
2:47:28 PM



REVISIONS

01 CITY REVIEW

REVISIONS

ENGINEER: CP

CHECKED BY: CP

DATE: 2024.02.28

TITLE: STRUCTURAL
ANALYSIS

PROJECT #: ----

| 2nd Floor Framing | | | |
|----------------------------------------|------------------------|----------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Member Name | Results (Max UTIL %) | Current Solution | Comments |
| Floor Joist 16' and Under | Passed (96% M) | 1 piece(s) 11 7/8" TJI@ 110 @ 16" OC | <div>City of Puyallup</div> <div>Development & Permitting Services</div> <div>ISSUED PERMIT</div> <div>Building Planning</div> <div>Engineering Public Works</div> <div>Fire Traffic</div> |
| Cantilever Floor Joist (Grid 13) | Passed (82% R) | 1 piece(s) 11 7/8" TJI@ 110 @ 16" OC | |
| 8'-5" Landing Joists | Passed (90% R) | 1 piece(s) 2 x 12 HF No.2 @ 12" OC | |
| Short Stair Stringers | Passed (72% R) | 1 piece(s) 4 x 12 HF No.2 | |
| Long Short Stair Stringers | Passed (98% R) | 1 piece(s) 3 1/2" x 12" 24F-V4 DF Glulam | |
| Top Landing Beam | Passed (100% R) | 1 piece(s) 5 1/2" x 13 1/2" 24F-V4 DF Glulam | |
| 8'-10" Deck Joist | Passed (55% R) | 1 piece(s) 2 x 12 HF No.2 @ 16" OC | |
| 6' Window Header | Passed (79% M) | 1 piece(s) 4 x 10 DF No.2 | |
| Grid 2 (B.6-B.8) Flush Beam | Passed (57% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 12 (B.6-B.8) Flush Beam | Passed (57% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 3.1 (B.6-B.8) Flush Beam | Passed (56% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 10.9 (B.6-B.8) Flush Beam | Passed (56% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 5.2 (B.5-B.7) Flush Beam | Passed (74% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 8.8 (B.5-B.7) Flush Beam | Passed (74% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 5.2 (B.9-C) Bathroom Door Header | Passed (83% M) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 8.8 (B.9-C) Bathroom Door Header | Passed (83% M) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 6.2 (B.4-B.5) Bedroom Door Header | Passed (74% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 7.8 (B.4-B.5) Bedroom Door Header | Passed (74% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 6.2 (B.7-C) Flush Beam | Passed (63% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | Squash Blocks Required |
| Grid 7.8 (B.7-C) Flush Beam | Passed (63% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | Squash Blocks Required |
| Grid 2.3 (D-D.1) Bedroom Door Header | Passed (60% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 11.7 (D-D.1) Bedroom Door Header | Passed (60% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 2.7 (D.2-D.4) Flush Beam | Passed (70% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 11.3 (D.2-D.4) Flush Beam | Passed (70% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 5.6 (D-D.3) Flush Beam | Passed (90% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 8.4 (D-D.3) Flush Beam | Passed (90% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 6 (D.5-D.6) Bedroom Door Header | Passed (83% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Main Landing Post | Passed (97% B/C) | 1 piece(s) 6 x 10 DF No.2 | |
| Grid 6.2B.6 Post | Passed (80% f_{cp}) | 1 piece(s) 4 x 6 DF No.2 | |
| Grid 7.8B.6 Post | Passed (80% f_{cp}) | 1 piece(s) 4 x 6 DF No.2 | |

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |




8/23/2024 7:44:30 PM UTC
ForteWEB v3.8
File Name: East Town Crossing Building H


| 3rd Floor Framing | | | |
|-----------------------------------------|----------------------|----------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Member Name | Results (Max UTIL %) | Current Solution | Comments |
| Floor Joist 16' and Under | Passed (96% M) | 1 piece(s) 11 7/8" TJI@ 110 @ 16" OC | <div>City of Puyallup</div> <div>Development & Permitting Services</div> <div>ISSUED PERMIT</div> <div> <div>Building</div> <div>Planning</div> <div>Engineering</div> <div>Public Works</div> <div>Fire</div> <div>Traffic</div> </div> |
| 8'-5" Landing Joists | Passed (90% R) | 1 piece(s) 2 x 12 HF No.2 @ 12" OC | |
| Short Stair Stringers | Passed (72% R) | 1 piece(s) 4 x 12 HF No.2 | |
| Top Landing Beam | Passed (84% ΔL) | 1 piece(s) 5 1/2" x 12" 24F-V4 DF Glulam | |
| 4' Mid Landing Joists | Passed (63% R) | 1 piece(s) 2 x 8 HF No.2 @ 16" OC | |
| Mid Landing Inner Beam | Passed (72% ΔL) | 1 piece(s) 5 1/2" x 12" 24F-V4 DF Glulam | |
| Mid Landing Outer Beam | Passed (83% ΔL) | 1 piece(s) 3 1/2" x 10 1/2" 24F-V4 DF Glulam | |
| 8'-10" Deck Joist | Passed (55% R) | 1 piece(s) 2 x 12 HF No.2 @ 16" OC | |
| 6' Window Header | Passed (79% M) | 1 piece(s) 4 x 10 DF No.2 | |
| Grid 2 (B.6-B.8) Flush Beam | Passed (28% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 12 (B.6-B.8) Flush Beam | Passed (28% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 3.1 (B.6-B.8) Flush Beam | Passed (28% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 10.9 (B.6-B.8) Flush Beam | Passed (28% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 5.2 (B.6-B.8) Flush Beam | Passed (34% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 8.8 (B.6-B.8) Flush Beam | Passed (34% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 5.2 (B.8-B.9) Bathroom Door Header | Passed (33% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 8.8 (B.8-B.9) Bathroom Door Header | Passed (33% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 6.2 (B.4-B.5) Bedroom Door Header | Passed (37% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 7.8 (B.4-B.5) Bedroom Door Header | Passed (37% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 6.2 (B.7-C) Flush Beam | Passed (63% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 7.8 (B.7-C) Flush Beam | Passed (63% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 2.3 (D-D.1) Bedroom Door Header | Passed (30% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 11.7 (D-D.1) Bedroom Door Header | Passed (30% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 2.7 (D.2-D.4) Flush Beam | Passed (35% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 11.3 (D.2-D.4) Flush Beam | Passed (35% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 5.6 (D-D.3) Flush Beam | Passed (62% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 8.4 (D-D.3) Flush Beam | Passed (62% R) | 1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam | |
| Grid 6 (D.5-D.6) Bedroom Door Header | Passed (42% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Grid 8 (D.5-D.6) Bedroom Door Header | Passed (42% R) | 1 piece(s) 4 x 8 DF No.2 | |
| Roof Framing | | | |
| Member Name | Results (Max UTIL %) | Current Solution | Comments |
| Grid D.7 Entry Roof Beam | Passed (102% R) | 1 piece(s) 3 1/2" x 10 1/2" 24F-V4 DF Glulam | |
| Grid A 7'-3" Deck Roof Beam | Passed (77% M+) | 1 piece(s) 3 1/2" x 7 1/2" 24F-V4 DF Glulam | |
| Grid G 9' Deck Roof Beam | Passed (91% M+) | 1 piece(s) 3 1/2" x 9" 24F-V4 DF Glulam | |
| 6' Window Header | Passed (90% R) | 1 piece(s) 4 x 10 DF No.2 | |

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |





2nd Floor Framing, Floor Joist 16' and Under
1 piece(s) 11 7/8" TJI® 110 @ 16" OC

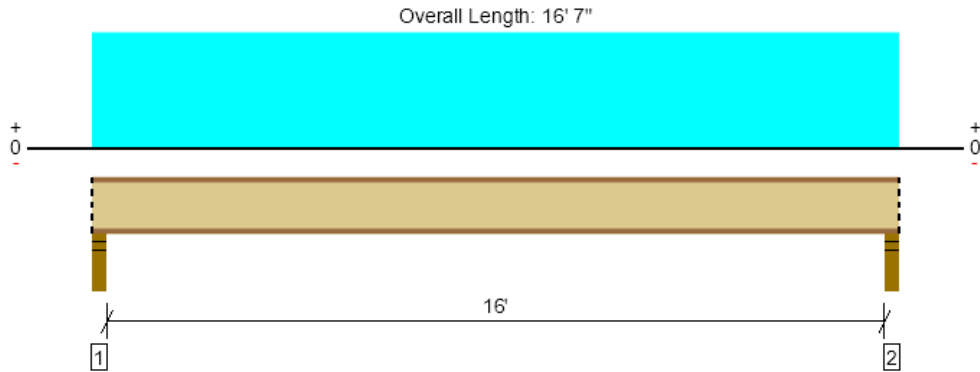

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|----------------|------|-----------------------------|
| Member Reaction (lbs) | 774 @ 2 1/2" | 1375 (3.50") | Passed (56%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 747 @ 3 1/2" | 1560 | Passed (48%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 3049 @ 8' 3 1/2" | 3160 | Passed (96%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.275 @ 8' 3 1/2" | 0.539 | Passed (L/704) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.482 @ 8' 3 1/2" | 0.808 | Passed (L/403) | -- | 1.0 D + 1.0 L (All Spans) |
| TJ-Pro™ Rating | 48 | 40 | Passed | -- | -- |

Member Length : 16' 7"
System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: 5/8" Gypsum ceiling.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.75" | 332 | 442 | 774 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.75" | 332 | 442 | 774 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 1" o/c | |
| Bottom Edge (Lu) | 16' 7" o/c | |

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

| Vertical Load | Location | Spacing | Dead (0.90) | Floor Live (1.00) | Comments |
|-------------------|-------------|---------|-------------|-------------------|--------------|
| 1 - Uniform (PSF) | 0 to 16' 7" | 16" | 30.0 | 40.0 | Default Load |

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator


| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H



2nd Floor Framing, Cantilever Floor Joist (Grid 13)
1 piece(s) 11 7/8" TJI® 110 @ 16" OC

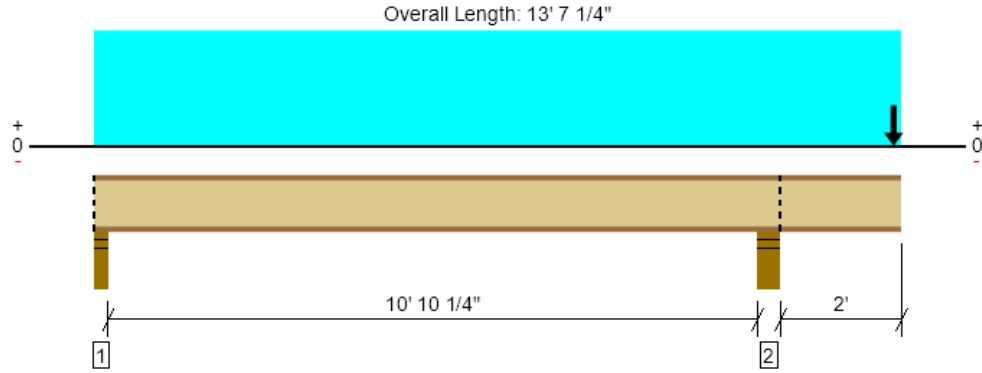

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1924 @ 11' 4 1/2" | 2350 (5.25") | Passed (82%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1175 @ 11' 7 1/4" | 1560 | Passed (75%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | -2311 @ 11' 4 1/2" | 3160 | Passed (73%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.063 @ 13' 7 1/4" | 0.200 | Passed (2L/852) | -- | 1.0 D + 1.0 L (Alt Spans) |
| Total Load Defl. (in) | 0.132 @ 13' 7 1/4" | 0.223 | Passed (2L/404) | -- | 1.0 D + 1.0 L (Alt Spans) |
| TJ-Pro™ Rating | 62 | 40 | Passed | -- | -- |

Member Length : 13' 7 1/4"
 System : Floor
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2018
 Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Overhang deflection criteria: LL (0.2") and TL (2L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: 5/8" Gypsum ceiling.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Snow | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.75" | 107 | 309/-82 | -9 | 416 | Blocking |
| 2 - Stud wall - HF | 5.50" | 5.50" | 3.50" | 1053 | 871 | 59 | 1924 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 6' 3" o/c | |
| Bottom Edge (Lu) | 3' 8" o/c | |

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Spacing | Dead (0.90) | Floor Live (1.00) | Snow (1.15) | Comments |
|-------------------|-----------------|---------|-------------|-------------------|-------------|---------------|
| 1 - Uniform (PSF) | 0 to 13' 7 1/4" | 16" | 30.0 | 40.0 | - | Default Load |
| 2 - Point (lb) | 13' 5 3/4" | N/A | 279 | 372 | - | Level 3 Floor |
| 3 - Point (lb) | 13' 5 3/4" | N/A | 287 | - | - | Walls |
| 4 - Point (lb) | 13' 5 3/4" | N/A | 50 | - | 50 | Roof |

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator


| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
 ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
 File Name: East Town Crossing Building H



2nd Floor Framing, 8'-5" Landing Joists
1 piece(s) 2 x 12 HF No.2 @ 12" OC

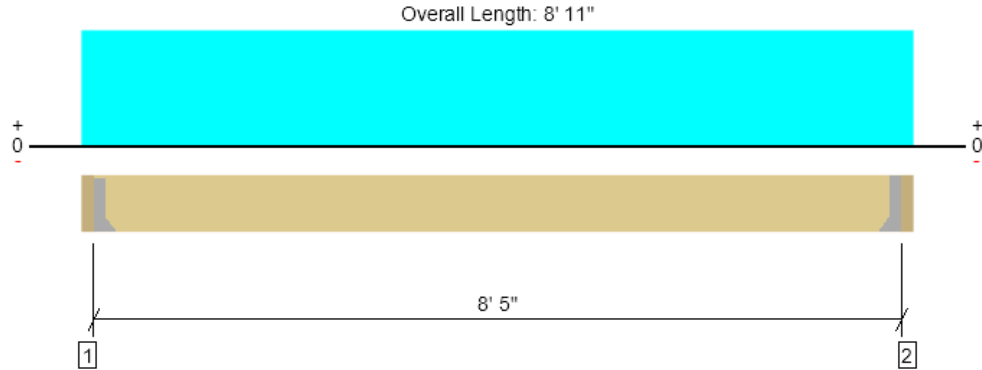

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|-------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 821 @ 3" | 911 (1.50") | Passed (90%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 638 @ 1' 2 1/4" | 1688 | Passed (38%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 1727 @ 4' 5 1/2" | 2577 | Passed (67%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.073 @ 4' 5 1/2" | 0.281 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.095 @ 4' 5 1/2" | 0.421 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| TJ-Pro™ Rating | N/A | N/A | N/A | -- | N/A |

Member Length : 8' 5"
System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------------------|----------------|---------------------|----------|-------------------------|------------|----------|-----------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Hanger on 11 1/4" LSL beam | 3.00" | Hanger ¹ | 1.50" | 201 | 669 | 869 | See note ¹ |
| 2 - Hanger on 11 1/4" LSL beam | 3.00" | Hanger ¹ | 1.50" | 201 | 669 | 869 | See note ¹ |

• At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger

• ¹ See Connector grid below for additional information and/or requirements.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 6' 4" o/c | |
| Bottom Edge (Lu) | 8' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

| Support | Model | Seat Length | Top Fasteners | Face Fasteners | Member Fasteners | Accessories |
|-----------------------|-------|-------------|---------------|----------------|------------------|-------------|
| 1 - Face Mount Hanger | LUS28 | 1.75" | N/A | 6-10dx1.5 | 3-10d | |
| 2 - Face Mount Hanger | LUS28 | 1.75" | N/A | 6-10dx1.5 | 3-10d | |

• Refer to manufacturer notes and instructions for proper installation and use of all connectors.

| Vertical Load | Location (Side) | Spacing | Dead (0.90) | Floor Live (1.00) | Comments |
|-------------------|-----------------|---------|-------------|-------------------|--------------|
| 1 - Uniform (PSF) | 0 to 8' 11" | 12" | 45.0 | 150.0 | Default Load |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Short Stair Stringers
1 piece(s) 4 x 12 HF No.2

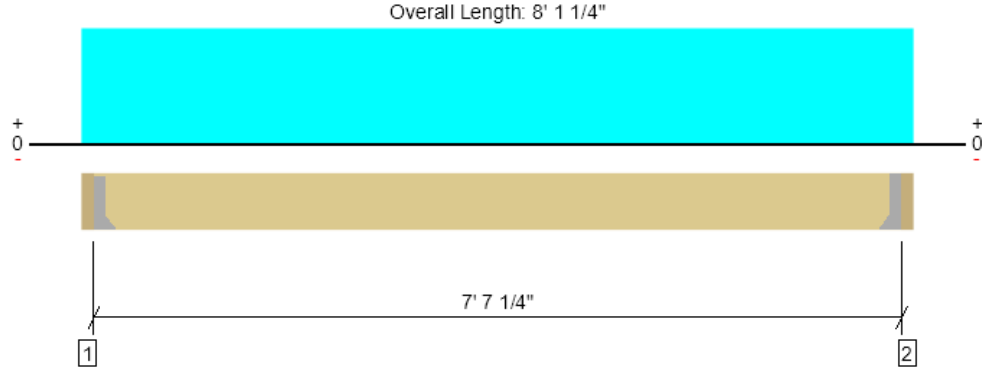

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1521 @ 3" | 2126 (1.50") | Passed (72%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1146 @ 1' 2 1/4" | 3938 | Passed (29%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 2891 @ 4' 5/8" | 5752 | Passed (50%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.042 @ 4' 5/8" | 0.190 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.056 @ 4' 5/8" | 0.380 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 7' 7 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------------------|----------------|---------------------|----------|-------------------------|------------|----------|-----------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Hanger on 11 1/4" GLB beam | 3.00" | Hanger ¹ | 1.50" | 403 | 1216 | 1618 | See note ¹ |
| 2 - Hanger on 11 1/4" GLB beam | 3.00" | Hanger ¹ | 1.50" | 403 | 1216 | 1618 | See note ¹ |

- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 7' 7" o/c | |
| Bottom Edge (Lu) | 7' 7" o/c | |

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

| Support | Model | Seat Length | Top Fasteners | Face Fasteners | Member Fasteners | Accessories |
|-----------------------|--------|-------------|---------------|----------------|------------------|-------------|
| 1 - Face Mount Hanger | LUS410 | 2.00" | N/A | 8-16d | 6-16d | |
| 2 - Face Mount Hanger | LUS410 | 2.00" | N/A | 8-16d | 6-16d | |

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 3" to 7' 10 1/4" | N/A | 10.0 | -- | |
| 1 - Uniform (PSF) | 0 to 8' 1 1/4" (Front) | 2' | 45.0 | 150.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Long Short Stair Stringers
1 piece(s) 3 1/2" x 12" 24F-V4 DF Glulam

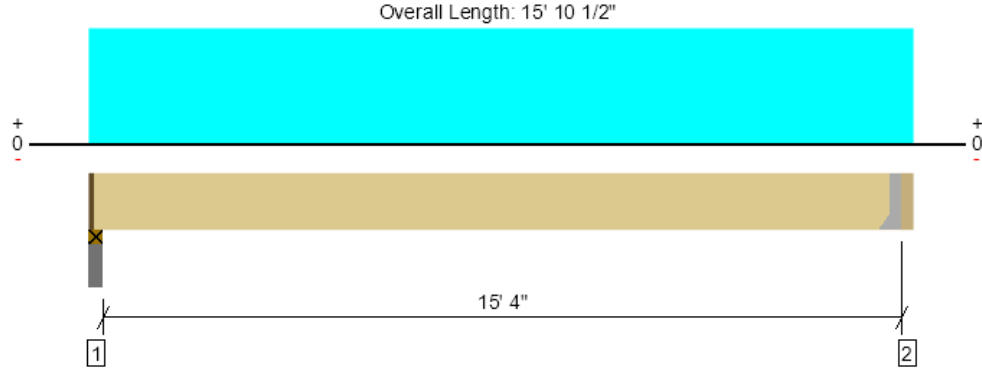

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|--------------|----------------|------|-----------------------------|
| Member Reaction (lbs) | 3118 @ 2" | 3189 (2.25") | Passed (98%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 2693 @ 14' 7 1/2" | 7420 | Passed (36%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 11954 @ 7' 10 3/4" | 16800 | Passed (71%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.425 @ 7' 10 3/4" | 0.515 | Passed (L/437) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.567 @ 7' 10 3/4" | 0.773 | Passed (L/327) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 15' 6 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 15' 5 1/2".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|----------------------------|----------------|---------------------|----------|-------------------------|------------|----------|-----------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Plate on concrete - HF | 3.50" | 2.25" | 2.20" | 790 | 2369 | 3159 | 1 1/4" Rim Board |
| 2 - Hanger on 12" GLB beam | 3.00" | Hanger ¹ | 1.50" | 797 | 2394 | 3191 | See note ¹ |

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 15' 6" o/c | |
| Bottom Edge (Lu) | 15' 6" o/c | |

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

| Support | Model | Seat Length | Top Fasteners | Face Fasteners | Member Fasteners | Accessories |
|-----------------------|---------|-------------|---------------|----------------|------------------|-------------|
| 2 - Face Mount Hanger | HHUS410 | 3.00" | N/A | 30-10d | 10-10d | |

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|--------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 1 1/4" to 15' 7 1/2" | N/A | 10.2 | -- | |
| 1 - Uniform (PSF) | 0 to 15' 10 1/2" (Front) | 2' | 45.0 | 150.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.


| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator



| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



2nd Floor Framing, Top Landing Beam
1 piece(s) 5 1/2" x 13 1/2" 24F-V4 DF Glulam

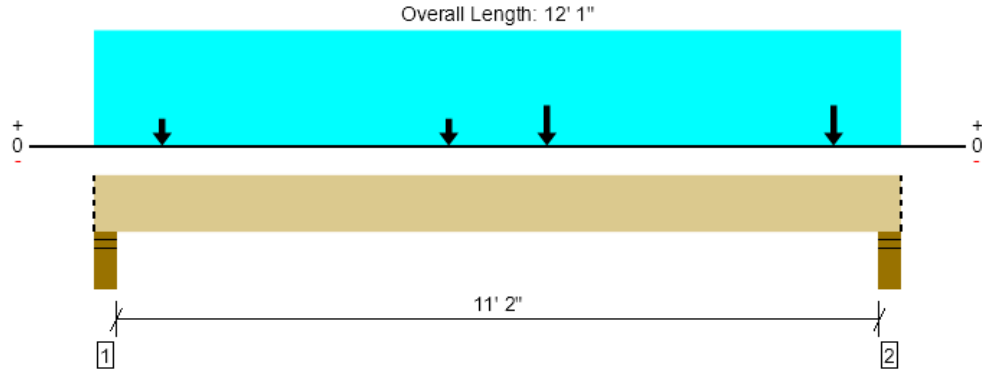

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|---------------|----------------|------|-----------------------------|
| Member Reaction (lbs) | 12196 @ 11' 9" | 12251 (5.50") | Passed (100%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 8941 @ 10' 6" | 13118 | Passed (68%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 31638 @ 6' 9" | 33413 | Passed (95%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.265 @ 6' 1" | 0.285 | Passed (L/516) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.352 @ 6' 1 1/16" | 0.571 | Passed (L/389) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 11' 5".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Member Length : 12' 1"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 5.50" | 5.50" | 4.76" | 2604 | 7997 | 10601 | Blocking |
| 2 - Stud wall - HF | 5.50" | 5.50" | 5.48" | 3004 | 9192 | 12196 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 12' 1" o/c | |
| Bottom Edge (Lu) | 12' 1" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|---------------------|-----------------|-------------|-------------------|----------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 12' 1" | N/A | 18.0 | -- | |
| 1 - Uniform (PSF) | 0 to 12' 1" (Front) | 5' 6" | 45.0 | 150.0 | Default Load |
| 2 - Point (lb) | 5' 3 3/4" (Front) | N/A | 403 | 1216 | Linked from: Short Stair Stringers, Support 1 |
| 3 - Point (lb) | 1' 1/4" (Front) | N/A | 403 | 1216 | Linked from: Short Stair Stringers, Support 1 |
| 4 - Point (lb) | 6' 9 3/8" (Front) | N/A | 797 | 2394 | Linked from: Long Short Stair Stringers, Support 2 |
| 5 - Point (lb) | 11' 7/8" (Front) | N/A | 797 | 2394 | Linked from: Long Short Stair Stringers, Support 2 |

- Side loads are assumed to not induce cross-grain tension.

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |




8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator



| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



2nd Floor Framing, 8'-10" Deck Joist
1 piece(s) 2 x 12 HF No.2 @ 16" OC

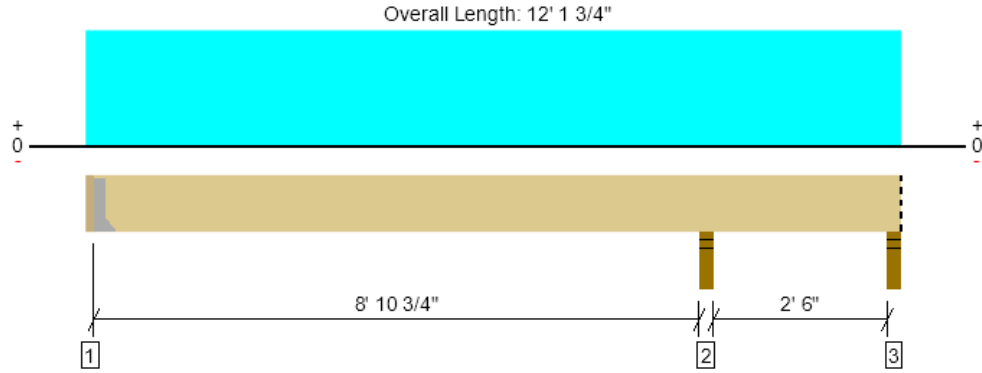

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1168 @ 9' 2 1/2" | 2126 (3.50") | Passed (55%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 520 @ 8' 1 1/2" | 1688 | Passed (31%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | -968 @ 9' 2 1/2" | 2577 | Passed (38%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.028 @ 4' 2 7/8" | 0.301 | Passed (L/999+) | -- | 1.0 D + 1.0 L (Alt Spans) |
| Total Load Defl. (in) | 0.042 @ 4' 2 3/4" | 0.452 | Passed (L/999+) | -- | 1.0 D + 1.0 L (Alt Spans) |
| TJ-Pro™ Rating | N/A | N/A | N/A | -- | N/A |

Member Length : 11' 11 3/4"
System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- 285 lbs uplift at support located at 11' 11 1/4". Strapping or other restraint may be required.
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|-------------------------------|----------------|---------------------|----------|-------------------------|------------|----------|-----------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Hanger on 11 1/4" HF beam | 2.00" | Hanger ¹ | 1.50" | 152 | 306 | 457 | See note ¹ |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.92" | 389 | 779 | 1168 | None |
| 3 - Stud wall - HF | 3.50" | 3.50" | 1.50" | -55 | 120/-230 | 64/-285 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 12' o/c | |
| Bottom Edge (Lu) | 12' o/c | |

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

| Support | Model | Seat Length | Top Fasteners | Face Fasteners | Member Fasteners | Accessories |
|-----------------------|-------|-------------|---------------|----------------|------------------|-------------|
| 1 - Face Mount Hanger | LUS28 | 1.75" | N/A | 6-10dx1.5 | 3-10d | |

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

| Vertical Load | Location (Side) | Spacing | Dead (0.90) | Floor Live (1.00) | Comments |
|-------------------|-----------------|---------|-------------|-------------------|--------------|
| 1 - Uniform (PSF) | 0 to 12' 1 3/4" | 16" | 30.0 | 60.0 | Default Load |


| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.eyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator




| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



MEMBER REPORT

PASSED

2nd Floor Framing, 6' Window Header
1 piece(s) 4 x 10 DF No.2

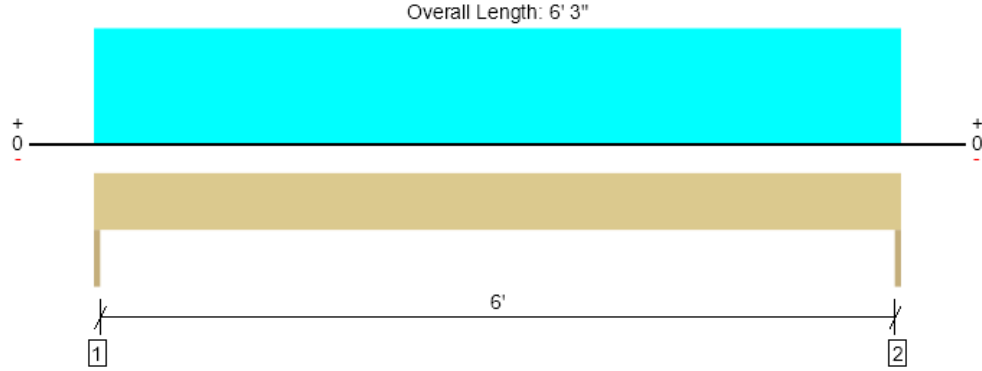

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2272 @ 0 | 3281 (1.50") | Passed (69%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1621 @ 10 3/4" | 3885 | Passed (42%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 3550 @ 3' 1 1/2" | 4492 | Passed (79%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.031 @ 3' 1 1/2" | 0.208 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.068 @ 3' 1 1/2" | 0.313 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 6' 3"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1215 | 1057 | 2272 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1215 | 1057 | 2272 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 6' 3" o/c | |
| Bottom Edge (Lu) | 6' 3" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|----------|
| 0 - Self Weight (PLF) | 0 to 6' 3" | N/A | 8.2 | -- | |
| 1 - Uniform (PSF) | 0 to 6' 3" | 6' 7" | 30.0 | 40.0 | Floor |
| 2 - Uniform (PLF) | 0 to 6' 3" | N/A | 108.0 | - | Wall |
| 3 - Uniform (PSF) | 0 to 6' 3" | 3' | 25.0 | 25.0 | Roof |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 2 (B.6-B.8) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

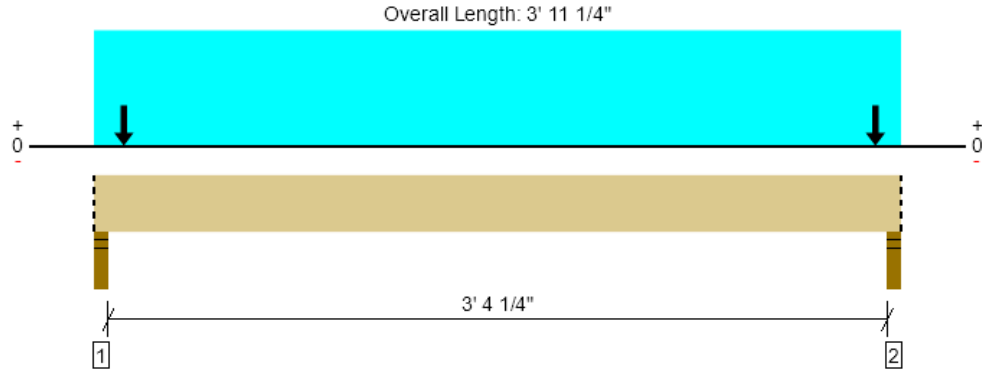

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2818 @ 2" | 4961 (3.50") | Passed (57%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 492 @ 1' 3 3/8" | 7343 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1163 @ 1' 11 5/8" | 16452 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.002 @ 1' 11 5/8" | 0.090 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.003 @ 1' 11 5/8" | 0.180 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 3' 7 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Member Length : 3' 11 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.99" | 1230 | 1588 | 2818 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.99" | 1230 | 1588 | 2818 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 11" o/c | |
| Bottom Edge (Lu) | 3' 11" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|-------------------------|-----------------|-------------|-------------------|-----------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 3' 11 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 11 1/4" (Front) | 10' 1" | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 1 3/4" (Top) | N/A | 615 | 794 | Linked from: Grid 2 (B.6-B.8) Flush Beam, Support 1 |
| 3 - Point (lb) | 3' 9 3/4" (Top) | N/A | 615 | 794 | Linked from: Grid 2 (B.6-B.8) Flush Beam, Support 2 |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 12 (B.6-B.8) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

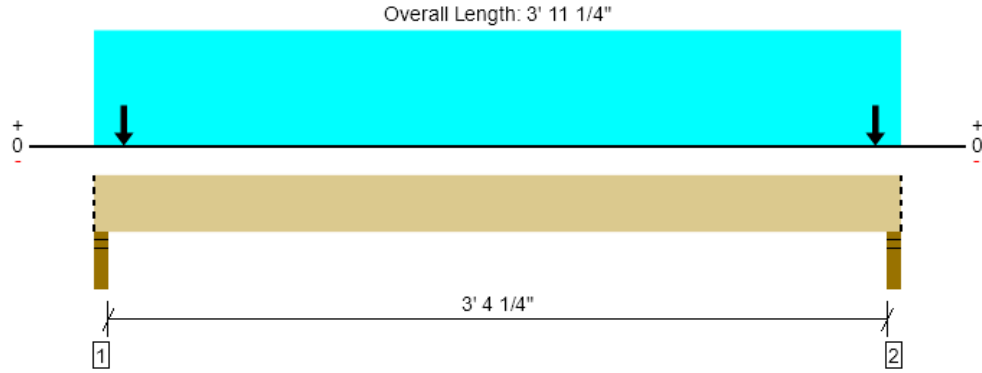

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2818 @ 2" | 4961 (3.50") | Passed (57%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 492 @ 1' 3 3/8" | 7343 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1163 @ 1' 11 5/8" | 16452 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.002 @ 1' 11 5/8" | 0.090 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.003 @ 1' 11 5/8" | 0.180 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 3' 7 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Member Length : 3' 11 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.99" | 1230 | 1588 | 2818 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.99" | 1230 | 1588 | 2818 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 11" o/c | |
| Bottom Edge (Lu) | 3' 11" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|-------------------------|-----------------|-------------|-------------------|-----------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 3' 11 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 11 1/4" (Front) | 10' 1" | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 1 3/4" (Top) | N/A | 615 | 794 | Linked from: Grid 2 (B.6-B.8) Flush Beam, Support 1 |
| 3 - Point (lb) | 3' 9 3/4" (Top) | N/A | 615 | 794 | Linked from: Grid 2 (B.6-B.8) Flush Beam, Support 2 |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 3.1 (B.6-B.8) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

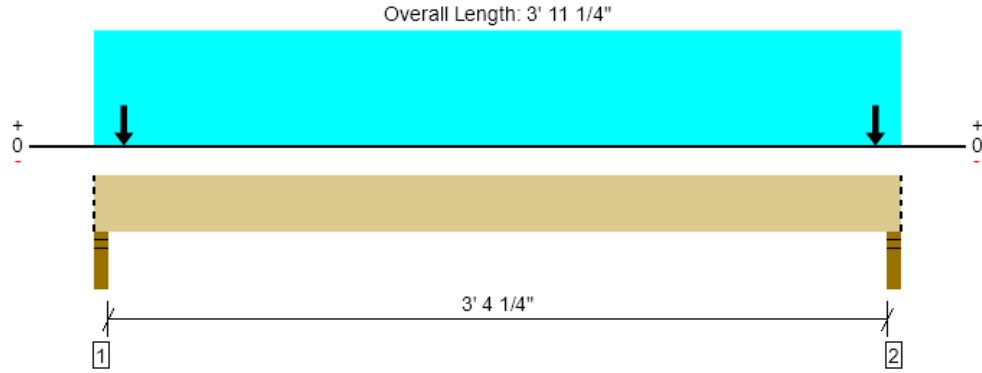

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2797 @ 2" | 4961 (3.50") | Passed (56%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 488 @ 1' 3 3/8" | 7343 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1153 @ 1' 11 5/8" | 16452 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.002 @ 1' 11 5/8" | 0.090 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.003 @ 1' 11 5/8" | 0.180 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 3' 7 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Member Length : 3' 11 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.97" | 1222 | 1576 | 2797 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.97" | 1222 | 1576 | 2797 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 11" o/c | |
| Bottom Edge (Lu) | 3' 11" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|-------------------------|-----------------|-------------|-------------------|-------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 3' 11 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 11 1/4" (Front) | 10' | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 1 3/4" (Top) | N/A | 611 | 788 | Linked from: Grid 3.1 (B.6-B.8) Flush Beam, Support 1 |
| 3 - Point (lb) | 3' 9 3/4" (Top) | N/A | 611 | 788 | Linked from: Grid 3.1 (B.6-B.8) Flush Beam, Support 2 |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 10.9 (B.6-B.8) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

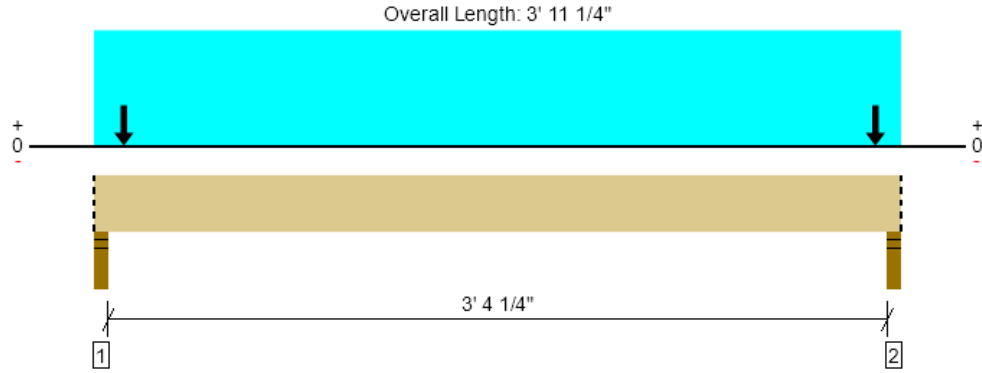

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2797 @ 2" | 4961 (3.50") | Passed (56%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 488 @ 1' 3 3/8" | 7343 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1153 @ 1' 11 5/8" | 16452 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.002 @ 1' 11 5/8" | 0.090 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.003 @ 1' 11 5/8" | 0.180 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 3' 7 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Member Length : 3' 11 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.97" | 1222 | 1576 | 2797 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.97" | 1222 | 1576 | 2797 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 11" o/c | |
| Bottom Edge (Lu) | 3' 11" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|-------------------------|-----------------|-------------|-------------------|-------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 3' 11 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 11 1/4" (Front) | 10' | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 1 3/4" (Top) | N/A | 611 | 788 | Linked from: Grid 3.1 (B.6-B.8) Flush Beam, Support 1 |
| 3 - Point (lb) | 3' 9 3/4" (Top) | N/A | 611 | 788 | Linked from: Grid 3.1 (B.6-B.8) Flush Beam, Support 2 |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator


| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 5.2 (B.5-B.7) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

Overall Length: 4' 8 1/4"

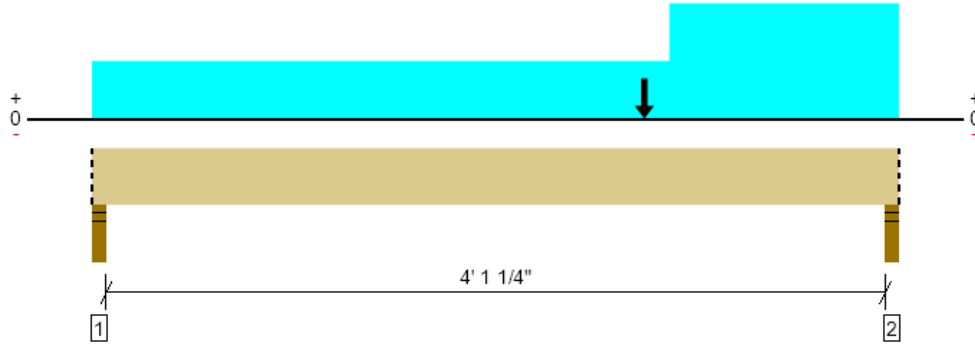

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 3651 @ 4' 6 1/4" | 4961 (3.50") | Passed (74%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1845 @ 3' 4 7/8" | 7343 | Passed (25%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 3277 @ 3' 2 7/16" | 16452 | Passed (20%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.007 @ 2' 5 1/4" | 0.109 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.012 @ 2' 5 1/4" | 0.218 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 4' 4 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Member Length : 4' 8 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.61" | 993 | 1283 | 2276 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 2.58" | 1588 | 2064 | 3651 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 4' 8" o/c | |
| Bottom Edge (Lu) | 4' 8" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|--------------------------------|-----------------|-------------|-------------------|-------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 4' 8 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 4' 8 1/4" (Front) | 10' | 30.0 | 40.0 | 2nd Floor |
| 2 - Uniform (PSF) | 3' 4 1/4" to 4' 8 1/4" (Front) | 10' | 30.0 | 40.0 | 3rd Floor |
| 3 - Point (lb) | 3' 2 1/2" (Top) | N/A | 727 | 938 | Linked from: Grid 5.2 (B.6-B.8) Flush Beam, Support 2 |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator


| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 8.8 (B.5-B.7) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

Overall Length: 4' 8 1/4"

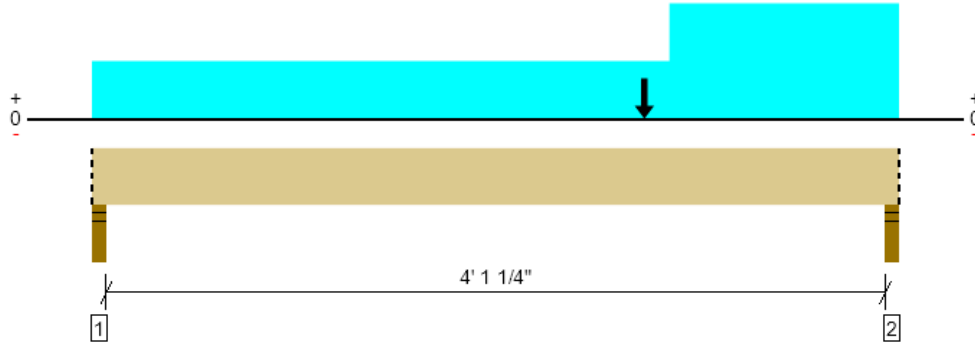

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 3651 @ 4' 6 1/4" | 4961 (3.50") | Passed (74%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1845 @ 3' 4 7/8" | 7343 | Passed (25%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 3277 @ 3' 2 7/16" | 16452 | Passed (20%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.007 @ 2' 5 1/4" | 0.109 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.012 @ 2' 5 1/4" | 0.218 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 4' 4 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Member Length : 4' 8 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.61" | 993 | 1283 | 2276 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 2.58" | 1588 | 2064 | 3651 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 4' 8" o/c | |
| Bottom Edge (Lu) | 4' 8" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|--------------------------------|-----------------|-------------|-------------------|-------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 4' 8 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 4' 8 1/4" (Front) | 10' | 30.0 | 40.0 | 2nd Floor |
| 2 - Uniform (PSF) | 3' 4 1/4" to 4' 8 1/4" (Front) | 10' | 30.0 | 40.0 | 3rd Floor |
| 3 - Point (lb) | 3' 2 1/2" (Top) | N/A | 727 | 938 | Linked from: Grid 5.2 (B.6-B.8) Flush Beam, Support 2 |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 5.2 (B.9-C) Bathroom Door Header
1 piece(s) 4 x 8 DF No.2

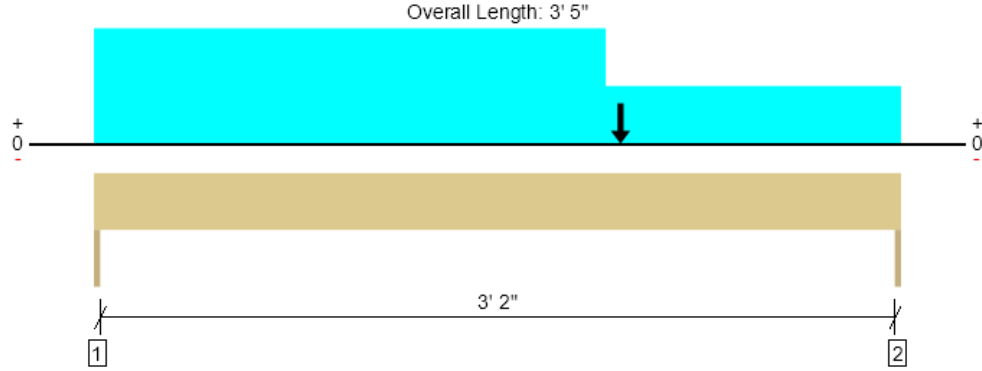

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2637 @ 0 | 3281 (1.50") | Passed (80%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1911 @ 2' 8 1/4" | 3045 | Passed (63%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 2472 @ 1' 10 1/2" | 2989 | Passed (83%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.016 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.029 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1138 | 1499 | 2637 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1050 | 1377 | 2426 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|-----------------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 10' | 30.0 | 40.0 | Default Load |
| 2 - Uniform (PSF) | 0 to 2' 2" | 10' | 30.0 | 40.0 | Default Load |
| 3 - Point (lb) | 2' 2 3/4" | N/A | 472 | 617 | Linked from: Grid 5.2 (B.8-B.9) Bathroom Door Header, Support 1 |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 8.8 (B.9-C) Bathroom Door Header
1 piece(s) 4 x 8 DF No.2

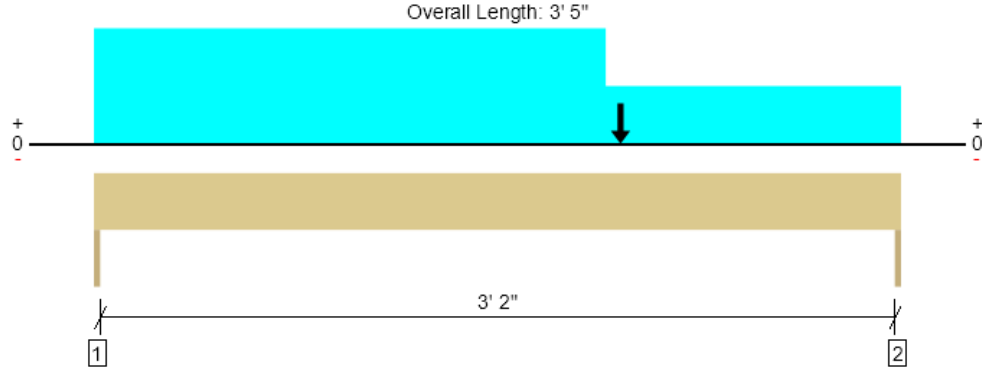

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2637 @ 0 | 3281 (1.50") | Passed (80%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1911 @ 2' 8 1/4" | 3045 | Passed (63%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 2472 @ 1' 10 1/2" | 2989 | Passed (83%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.016 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.029 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1138 | 1499 | 2637 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1050 | 1377 | 2426 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|-----------------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 10' | 30.0 | 40.0 | Default Load |
| 2 - Uniform (PSF) | 0 to 2' 2" | 10' | 30.0 | 40.0 | Default Load |
| 3 - Point (lb) | 2' 2 3/4" | N/A | 472 | 617 | Linked from: Grid 5.2 (B.8-B.9) Bathroom Door Header, Support 1 |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 6.2 (B.4-B.5) Bedroom Door Header
1 piece(s) 4 x 8 DF No.2

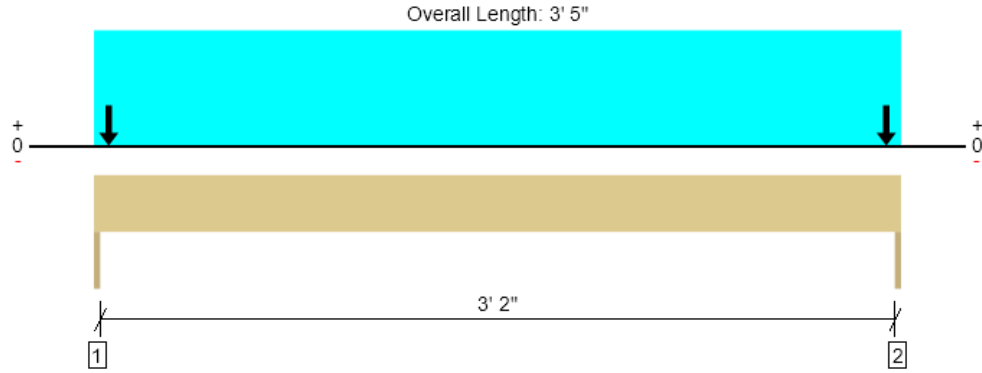

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2413 @ 0 | 3281 (1.50") | Passed (74%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 692 @ 8 3/4" | 3045 | Passed (23%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 1031 @ 1' 8 1/2" | 2989 | Passed (34%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.007 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.012 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1046 | 1366 | 2413 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1046 | 1366 | 2413 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|----------------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 10' | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 3/4" | N/A | 523 | 683 | Linked from: Grid 6.2 (B.4-B.5) Bedroom Door Header, Support 1 |
| 3 - Point (lb) | 3' 4 1/4" | N/A | 523 | 683 | Linked from: Grid 6.2 (B.4-B.5) Bedroom Door Header, Support 2 |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 7.8 (B.4-B.5) Bedroom Door Header
1 piece(s) 4 x 8 DF No.2

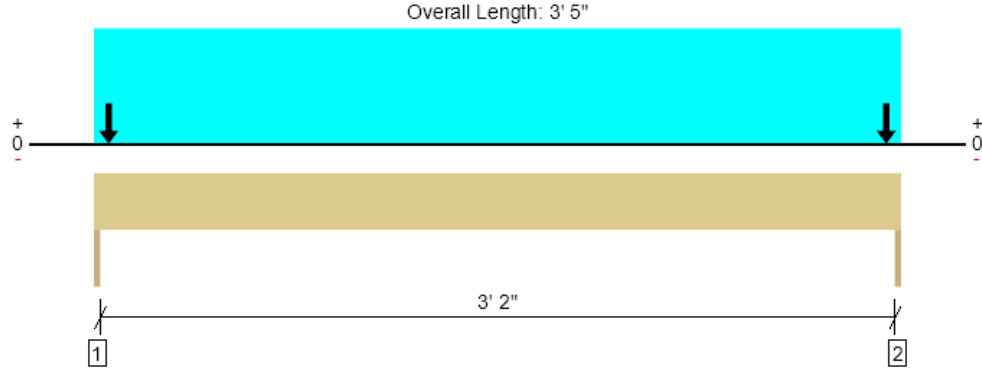

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2413 @ 0 | 3281 (1.50") | Passed (74%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 692 @ 8 3/4" | 3045 | Passed (23%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 1031 @ 1' 8 1/2" | 2989 | Passed (34%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.007 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.012 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1046 | 1366 | 2413 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1046 | 1366 | 2413 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|----------------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 10' | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 3/4" | N/A | 523 | 683 | Linked from: Grid 6.2 (B.4-B.5) Bedroom Door Header, Support 1 |
| 3 - Point (lb) | 3' 4 1/4" | N/A | 523 | 683 | Linked from: Grid 6.2 (B.4-B.5) Bedroom Door Header, Support 2 |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 6.2 (B.7-C) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

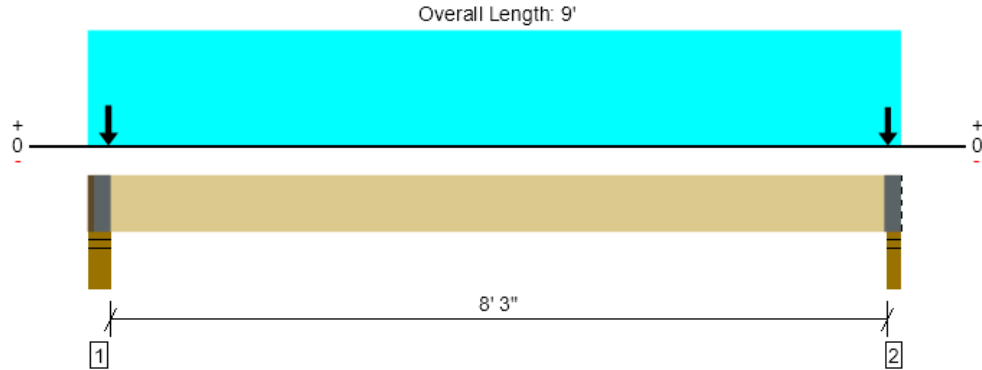

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 3136 @ 8' 10" | 4961 (3.50") | Passed (63%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 2226 @ 1' 5 3/8" | 7343 | Passed (30%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 6413 @ 4' 7" | 16452 | Passed (39%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.053 @ 4' 7" | 0.213 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.095 @ 4' 7" | 0.425 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 8' 10 1/2"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 8' 6".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|---------------------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 5.50" | 4.00" | 2.23" | 2840 | 3666 | 6506 | 1 1/2" Rim Board, Squash Blocks |
| 2 - Stud wall - HF | 3.50" | 3.50" | 2.21" | 2740 | 3534 | 6273 | Blocking, Squash Blocks |

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Squash Blocks must match bearing length and are assumed to carry all loads applied directly above them, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 8' 11" o/c | |
| Bottom Edge (Lu) | 8' 11" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------|-----------------|-------------|-------------------|-----------------------------------------------------|
| 0 - Self Weight (PLF) | 1 1/2" to 9' | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 9' (Front) | 10' | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 8' 10 1/4" (Top) | N/A | 1370 | 1767 | Linked from: Grid 6.2 (B.7-C) Flush Beam, Support 2 |
| 3 - Point (lb) | 2 3/4" (Top) | N/A | 1420 | 1833 | Linked from: Grid 6.2 (B.7-C) Flush Beam, Support 1 |

- Side loads are assumed to not induce cross-grain tension.


| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator



| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



2nd Floor Framing, Grid 7.8 (B.7-C) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

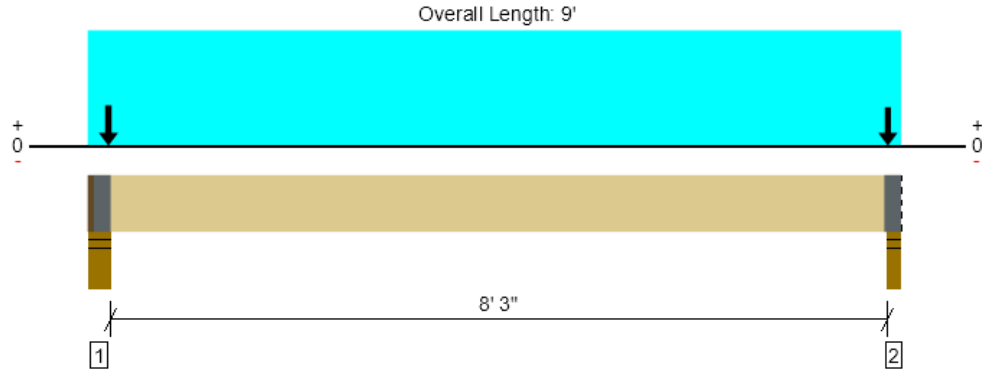

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 3136 @ 8' 10" | 4961 (3.50") | Passed (63%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 2226 @ 1' 5 3/8" | 7343 | Passed (30%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 6413 @ 4' 7" | 16452 | Passed (39%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.053 @ 4' 7" | 0.213 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.095 @ 4' 7" | 0.425 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 8' 10 1/2"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 8' 6".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|---------------------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 5.50" | 4.00" | 2.23" | 2840 | 3666 | 6506 | 1 1/2" Rim Board, Squash Blocks |
| 2 - Stud wall - HF | 3.50" | 3.50" | 2.21" | 2740 | 3534 | 6273 | Blocking, Squash Blocks |

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Squash Blocks must match bearing length and are assumed to carry all loads applied directly above them, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 8' 11" o/c | |
| Bottom Edge (Lu) | 8' 11" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------|-----------------|-------------|-------------------|-----------------------------------------------------|
| 0 - Self Weight (PLF) | 1 1/2" to 9' | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 9' (Front) | 10' | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 8' 10 1/4" (Top) | N/A | 1370 | 1767 | Linked from: Grid 6.2 (B.7-C) Flush Beam, Support 2 |
| 3 - Point (lb) | 2 3/4" (Top) | N/A | 1420 | 1833 | Linked from: Grid 6.2 (B.7-C) Flush Beam, Support 1 |

- Side loads are assumed to not induce cross-grain tension.

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |




8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator



| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



2nd Floor Framing, Grid 2.3 (D-D.1) Bedroom Door Header
1 piece(s) 4 x 8 DF No.2

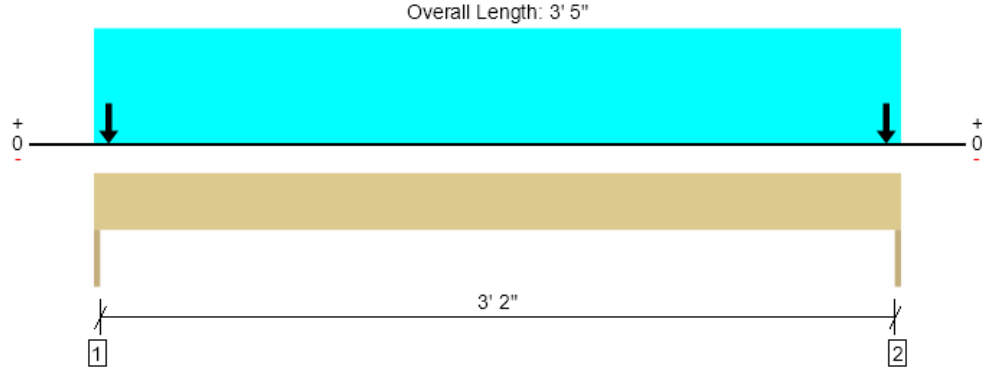

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1976 @ 0 | 3281 (1.50") | Passed (60%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 566 @ 8 3/4" | 3045 | Passed (19%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 844 @ 1' 8 1/2" | 2989 | Passed (28%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.006 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.010 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 860 | 1116 | 1976 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 860 | 1116 | 1976 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|--------------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 8' 2" | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 3/4" | N/A | 430 | 558 | Linked from: Grid 2.3 (D-D.1) Bedroom Door Header, Support 1 |
| 3 - Point (lb) | 3' 4 1/4" | N/A | 430 | 558 | Linked from: Grid 2.3 (D-D.1) Bedroom Door Header, Support 2 |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 11.7 (D-D.1) Bedroom Door Header
1 piece(s) 4 x 8 DF No.2

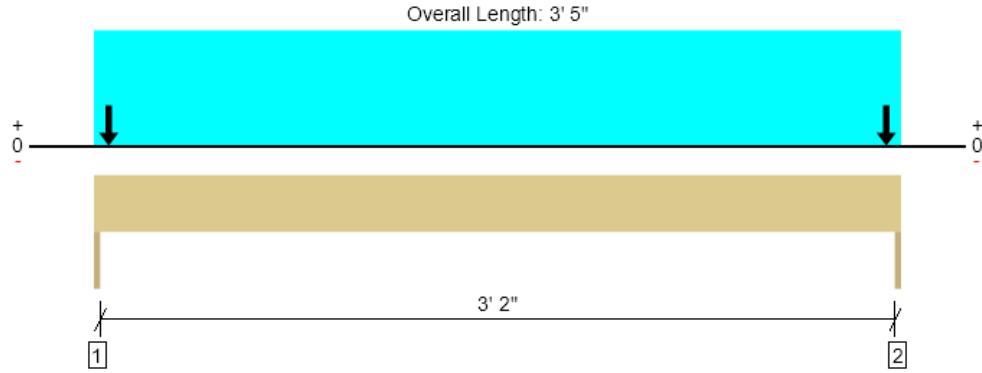

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1976 @ 0 | 3281 (1.50") | Passed (60%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 566 @ 8 3/4" | 3045 | Passed (19%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 844 @ 1' 8 1/2" | 2989 | Passed (28%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.006 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.010 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 860 | 1116 | 1976 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 860 | 1116 | 1976 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|--------------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 8' 2" | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 3/4" | N/A | 430 | 558 | Linked from: Grid 2.3 (D-D.1) Bedroom Door Header, Support 1 |
| 3 - Point (lb) | 3' 4 1/4" | N/A | 430 | 558 | Linked from: Grid 2.3 (D-D.1) Bedroom Door Header, Support 2 |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 2.7 (D.2-D.4) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

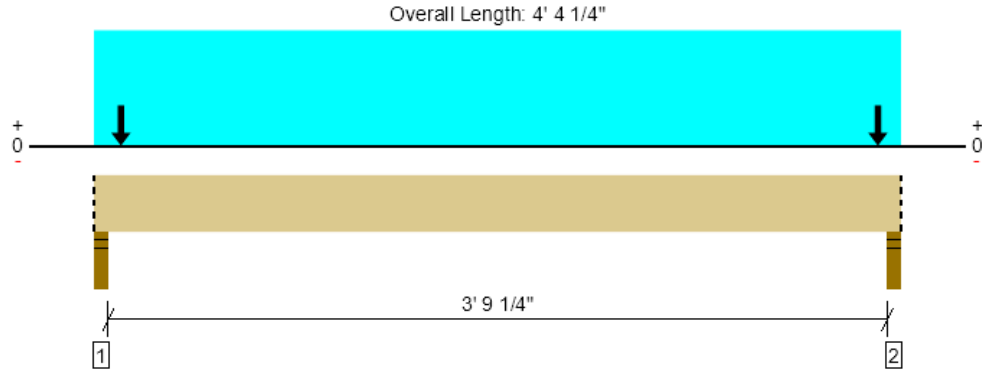

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 3473 @ 2" | 4961 (3.50") | Passed (70%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 715 @ 1' 3 3/8" | 7343 | Passed (10%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1612 @ 2' 2 1/8" | 16452 | Passed (10%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.003 @ 2' 2 1/8" | 0.101 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.005 @ 2' 2 1/8" | 0.201 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 4' 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Member Length : 4' 4 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 2.45" | 1514 | 1960 | 3473 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 2.45" | 1514 | 1960 | 3473 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 4' 4" o/c | |
| Bottom Edge (Lu) | 4' 4" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------------|-------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 4' 4 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 4' 4 1/4" (Front) | 11' 3" | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 1 3/4" (Top) | N/A | 757 | 980 | Linked from: Grid 2.7 (D.2-D.4) Flush Beam, Support 1 |
| 3 - Point (lb) | 4' 2 3/4" (Top) | N/A | 757 | 980 | Linked from: Grid 2.7 (D.2-D.4) Flush Beam, Support 2 |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 11.3 (D.2-D.4) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

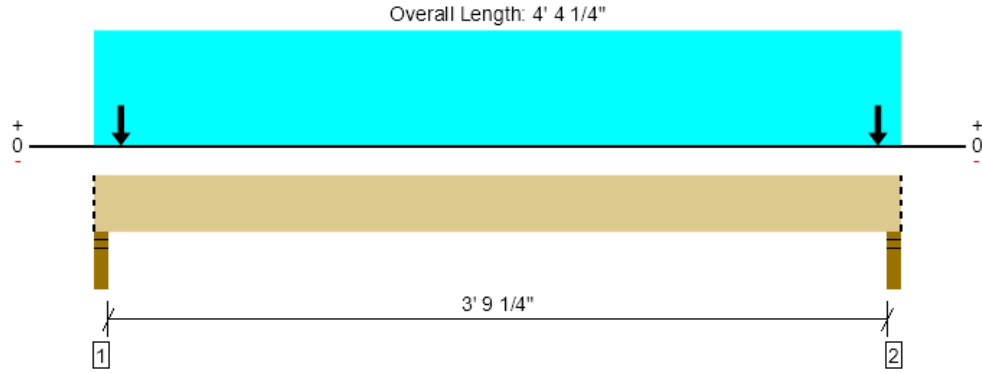

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 3473 @ 2" | 4961 (3.50") | Passed (70%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 715 @ 1' 3 3/8" | 7343 | Passed (10%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1612 @ 2' 2 1/8" | 16452 | Passed (10%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.003 @ 2' 2 1/8" | 0.101 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.005 @ 2' 2 1/8" | 0.201 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 4' 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Member Length : 4' 4 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 2.45" | 1514 | 1960 | 3473 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 2.45" | 1514 | 1960 | 3473 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 4' 4" o/c | |
| Bottom Edge (Lu) | 4' 4" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------------|-------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 4' 4 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 4' 4 1/4" (Front) | 11' 3" | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 1 3/4" (Top) | N/A | 757 | 980 | Linked from: Grid 2.7 (D.2-D.4) Flush Beam, Support 1 |
| 3 - Point (lb) | 4' 2 3/4" (Top) | N/A | 757 | 980 | Linked from: Grid 2.7 (D.2-D.4) Flush Beam, Support 2 |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

2nd Floor Framing, Grid 5.6 (D-D.3) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

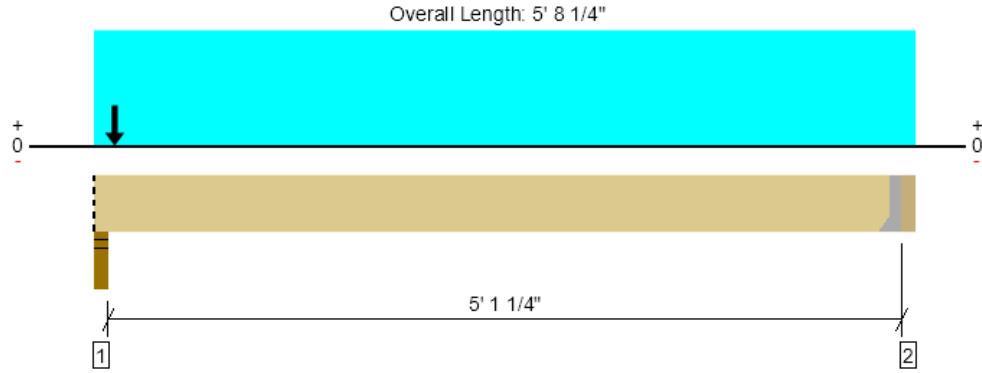

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 4470 @ 2" | 4961 (3.50") | Passed (90%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1306 @ 4' 4 7/8" | 7343 | Passed (18%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 2746 @ 2' 9 3/8" | 16452 | Passed (17%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.009 @ 2' 9 3/8" | 0.131 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.015 @ 2' 9 3/8" | 0.261 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 5' 4 3/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 5' 2 3/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------------------|----------------|---------------------|----------|-------------------------|------------|----------|-----------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 3.15" | 1948 | 2522 | 4470 | Blocking |
| 2 - Hanger on 11 7/8" LSL beam | 3.50" | Hanger ¹ | 1.50" | 1015 | 1318 | 2332 | See note ¹ |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 5' 5" o/c | |
| Bottom Edge (Lu) | 5' 5" o/c | |

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

| Support | Model | Seat Length | Top Fasteners | Face Fasteners | Member Fasteners | Accessories |
|-----------------------|--------|-------------|---------------|----------------|------------------|-------------|
| 2 - Face Mount Hanger | LUS414 | 2.00" | N/A | 10-16d | 6-16d | |

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------------|-----------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 5' 4 3/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 5' 8 1/4" (Front) | 11' 4" | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 1 3/4" (Top) | N/A | 974 | 1261 | Linked from: Grid 5.6 (D-D.3) Flush Beam, Support 1 |

- Side loads are assumed to not induce cross-grain tension.

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

City of Puyallup

Development & Permitting Services

ISSUED PERMIT

Building

Planning

Engineering

Public Works


Fire

Traffic

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



2nd Floor Framing, Grid 8.4 (D-D.3) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

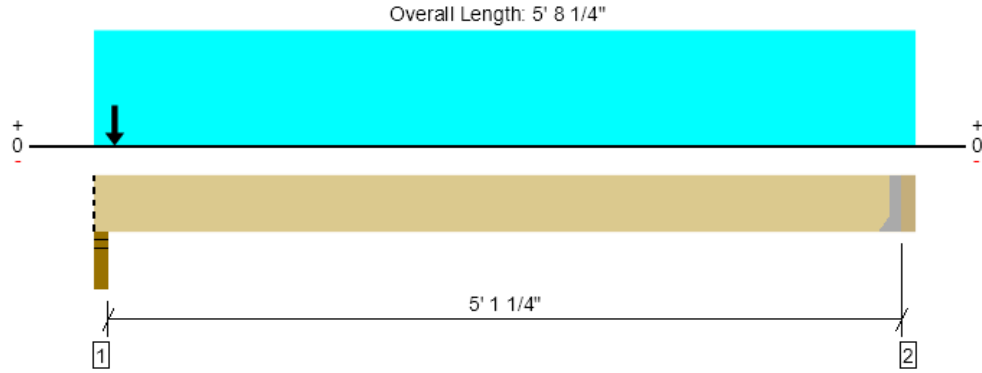

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 4470 @ 2" | 4961 (3.50") | Passed (90%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1306 @ 4' 4 7/8" | 7343 | Passed (18%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 2746 @ 2' 9 3/8" | 16452 | Passed (17%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.009 @ 2' 9 3/8" | 0.131 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.015 @ 2' 9 3/8" | 0.261 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 5' 4 3/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 5' 2 3/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------------------|----------------|---------------------|----------|-------------------------|------------|----------|-----------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 3.15" | 1948 | 2522 | 4470 | Blocking |
| 2 - Hanger on 11 7/8" LSL beam | 3.50" | Hanger ¹ | 1.50" | 1015 | 1318 | 2332 | See note ¹ |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 5' 5" o/c | |
| Bottom Edge (Lu) | 5' 5" o/c | |

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

| Support | Model | Seat Length | Top Fasteners | Face Fasteners | Member Fasteners | Accessories |
|-----------------------|--------|-------------|---------------|----------------|------------------|-------------|
| 2 - Face Mount Hanger | LUS414 | 2.00" | N/A | 10-16d | 6-16d | |

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------------|-----------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 5' 4 3/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 5' 8 1/4" (Front) | 11' 4" | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 1 3/4" (Top) | N/A | 974 | 1261 | Linked from: Grid 5.6 (D-D.3) Flush Beam, Support 1 |

- Side loads are assumed to not induce cross-grain tension.

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



Weyerhaeuser Notes

City of Puyallup
Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible for ensuring that the calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and are used in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/


Engineering
Traffic

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



2nd Floor Framing, Grid 6 (D.5-D.6) Bedroom Door Header
1 piece(s) 4 x 8 DF No.2

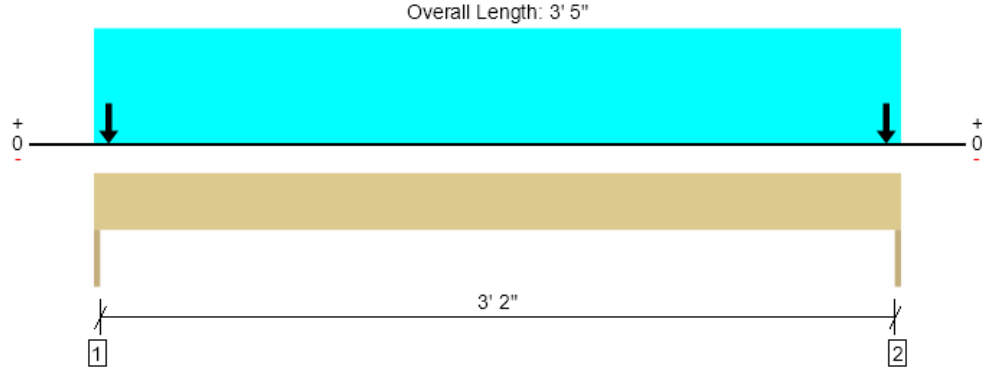

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2732 @ 0 | 3281 (1.50") | Passed (83%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 783 @ 8 3/4" | 3045 | Passed (26%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 1167 @ 1' 8 1/2" | 2989 | Passed (39%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.008 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.014 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1184 | 1548 | 2732 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1184 | 1548 | 2732 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|--------------------------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 11' 4" | 30.0 | 40.0 | Default Load |
| 2 - Point (lb) | 3/4" | N/A | 592 | 774 | Linked from: Grid 6 (D.5-D.6) Bedroom Door Header, Support 1 |
| 3 - Point (lb) | 3' 4 1/4" | N/A | 592 | 774 | Linked from: Grid 6 (D.5-D.6) Bedroom Door Header, Support 2 |

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H



MEMBER REPORT


PASSED

2nd Floor Framing, Main Landing Post
1 piece(s) 6 x 10 DF No.2

Wall Height: 9'

Member Height: 8' 7 1/2"

Tributary Width: 1' 4"

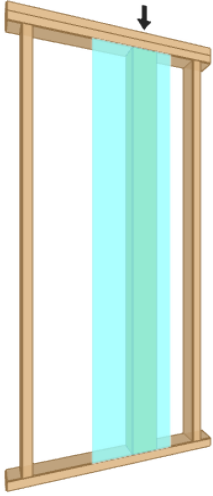

Drawing is Conceptual

| Design Results | Actual | Allowed | Result | LDF | Load: Combination |
|-------------------------|-----------------|---------|-----------------|------|-------------------|
| Slenderness | 11 | 50 | Passed (22%) | -- | -- |
| Compression (lbs) | 20238 | 30059 | Passed (67%) | 1.00 | 1.0 D + 1.0 L |
| Plate Bearing (lbs) | 20238 | 21161 | Passed (96%) | -- | 1.0 D + 1.0 L |
| Lateral Reaction (lbs) | 79 | -- | -- | 1.60 | 1.0 D + 0.6 W |
| Lateral Shear (lbs) | 65 | 9475 | Passed (1%) | 1.60 | 1.0 D + 0.6 W |
| Lateral Moment (ft-lbs) | 171 @ mid-span | 9642 | Passed (2%) | 1.60 | 1.0 D + 0.6 W |
| Total Deflection (in) | 0.04 @ mid-span | 0.86 | Passed (L/2401) | -- | 1.0 D + 1.0 L |
| Bending/Compression | 0.97 | 1 | Passed (97%) | 1.00 | 1.0 D + 1.0 L |

- Lateral deflection criteria: Wind (L/120)
- Input axial load eccentricity for this design is 16.67% of applicable member side dimension.
- Applicable calculations are based on NDS.
- Bearing shall be on a metal plate or strap, or on other equivalently durable, rigid, homogeneous material with sufficient stiffness to distribute applied load.
- Special detailing and installation procedures are necessary for large wall construction.
- Lumber grading provisions must be extended over the length of the member per NDS 4.2.5.5.

| Supports | Type | Material |
|----------|--------|----------|
| Top | Dbl 2X | Hem Fir |
| Base | 2X | Hem Fir |

System : Wall
Member Type : Column
Building Code : IBC 2018
Design Methodology : ASD

| Max Unbraced Length | Comments |
|---------------------|----------|
| 1' | |

| Lateral Connections | | | | |
|---------------------|-----------|----------------------------|----------|-------------------|
| Supports | Connector | Type/Model | Quantity | Connector Nailing |
| Top | Nails | 8d (0.113" x 2 1/2") (Toe) | 2 | N/A |
| Base | Nails | 8d (0.113" x 2 1/2") (Toe) | 2 | N/A |

- Nailed connection at the top of the member is assumed to be nailed through the bottom 2x plate prior to placement of the top 2x of the double top plate assembly.

| Vertical Loads | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|----------------|-----------------|-------------|-------------------|------------------------------------------|
| 1 - Point (lb) | N/A | 3004 | 9192 | Linked from: Top Landing Beam, Support 2 |
| 2 - Point (lb) | N/A | 1975 | 6067 | Linked from: Top Landing Beam, Support 1 |

| Lateral Load | Location | Tributary Width | Wind (1.60) | Comments |
|-------------------|-------------|-----------------|-------------|----------|
| 1 - Uniform (PSF) | Full Length | 1' 4" | 22.9 | |

- ASCE/SEI 7 Sec. 30.4: Exposure Category (B), Mean Roof Height (33'), Topographic Factor (1.0), Wind Directionality Factor (0.85), Basic Wind Speed (110), Risk Category(II), Wind Zone (4), GCpi (+/- 0.18), Effective Wind Area determined using full member span and trib. width.
- IBC Table 1604.3, footnote f: Deflection checks are performed using 42% of this lateral wind load.

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H
Page 37 / 76



MEMBER REPORT

PASSED


2nd Floor Framing, Grid 6.2B.6 Post

1 piece(s) 4 x 6 DF No.2

Wall Height: 9'

Member Height: 8' 7 1/2"

Tributary Width: 0

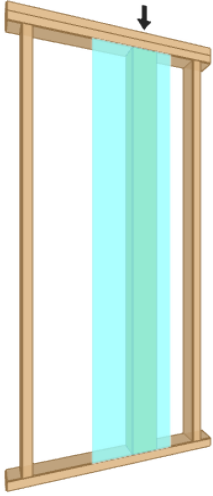

Drawing is Conceptual

| Design Results | Actual | Allowed | Result | LDF | Load: Combination |
|-------------------------|-----------------|---------|--------------|------|-------------------|
| Slenderness | 19 | 50 | Passed (38%) | -- | -- |
| Compression (lbs) | 6274 | 18757 | Passed (33%) | 1.00 | 1.0 D + 1.0 L |
| Plate Bearing (lbs) | 6274 | 7796 | Passed (80%) | -- | 1.0 D + 1.0 L |
| Lateral Reaction (lbs) | 0 | -- | -- | -- | N/A |
| Lateral Shear (lbs) | 0 | N/A | Passed (N/A) | -- | N/A |
| Lateral Moment (ft-lbs) | 0 @ mid-span | N/A | Passed (N/A) | -- | N/A |
| Total Deflection (in) | 0.00 @ mid-span | N/A | Passed (N/A) | -- | N/A |
| Bending/Compression | N/A | 1 | Passed (N/A) | -- | N/A |

- Lateral deflection criteria: Wind (L/180)
- Input axial load eccentricity for the design is zero
- Applicable calculations are based on NDS.
- Bearing shall be on a metal plate or strap, or on other equivalently durable, rigid, homogeneous material with sufficient stiffness to distribute applied load.

| Supports | Type | Material |
|----------|--------|----------|
| Top | Dbl 2X | Hem Fir |
| Base | 2X | Hem Fir |

System : Wall
Member Type : Column
Building Code : IBC 2018
Design Methodology : ASD

| Max Unbraced Length | Comments |
|---------------------|----------|
| 1' | |

Lateral Connections

| Supports | Connector | Type/Model | Quantity | Connector Nailing |
|----------|-----------|----------------------------|----------|-------------------|
| Top | Nails | 8d (0.113" x 2 1/2") (Toe) | 2 | N/A |
| Base | Nails | 8d (0.113" x 2 1/2") (Toe) | 2 | N/A |

- Nailed connection at the top of the member is assumed to be nailed through the bottom 2x plate prior to placement of the top 2x of the double top plate assembly.

| Vertical Load | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|----------------|-----------------|-------------|-------------------|-----------------------------------------------------|
| 1 - Point (lb) | N/A | 2740 | 3534 | Linked from: Grid 6.2 (B.7-C) Flush Beam, Support 2 |

| Lateral Load | Location | Tributary Width | Wind (1.60) | Comments |
|-------------------|-------------|-----------------|-------------|----------|
| 1 - Uniform (PSF) | Full Length | N/A | 22.9 | |

- ASCE/SEI 7 Sec. 30.4: Exposure Category (B), Mean Roof Height (33'), Topographic Factor (1.0), Wind Directionality Factor (0.85), Basic Wind Speed (110), Risk Category(II), Wind Zone (4), GCpi (+/- 0.18), Effective Wind Area determined using full member span and trib. width.
- IBC Table 1604.3, footnote f: Deflection checks are performed using 42% of this lateral wind load.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.eyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |




8/23/2024 7:44:30 PM UTC

ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3

File Name: East Town Crossing Building H

Page 38 / 76



MEMBER REPORT

PASSED


2nd Floor Framing, Grid 7.8B.6 Post

1 piece(s) 4 x 6 DF No.2

Wall Height: 9'

Member Height: 8' 7 1/2"

Tributary Width: 0

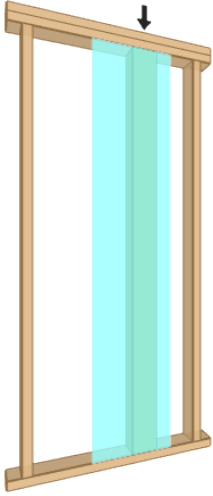

Drawing is Conceptual

| Design Results | Actual | Allowed | Result | LDF | Load: Combination |
|-------------------------|-----------------|---------|--------------|------|-------------------|
| Slenderness | 19 | 50 | Passed (38%) | -- | -- |
| Compression (lbs) | 6274 | 18757 | Passed (33%) | 1.00 | 1.0 D + 1.0 L |
| Plate Bearing (lbs) | 6274 | 7796 | Passed (80%) | -- | 1.0 D + 1.0 L |
| Lateral Reaction (lbs) | 0 | -- | -- | -- | N/A |
| Lateral Shear (lbs) | 0 | N/A | Passed (N/A) | -- | N/A |
| Lateral Moment (ft-lbs) | 0 @ mid-span | N/A | Passed (N/A) | -- | N/A |
| Total Deflection (in) | 0.00 @ mid-span | N/A | Passed (N/A) | -- | N/A |
| Bending/Compression | N/A | 1 | Passed (N/A) | -- | N/A |

- Lateral deflection criteria: Wind (L/180)
- Input axial load eccentricity for the design is zero
- Applicable calculations are based on NDS.
- Bearing shall be on a metal plate or strap, or on other equivalently durable, rigid, homogeneous material with sufficient stiffness to distribute applied load.

| Supports | Type | Material |
|----------|--------|----------|
| Top | Dbl 2X | Hem Fir |
| Base | 2X | Hem Fir |

System : Wall
Member Type : Column
Building Code : IBC 2018
Design Methodology : ASD

| Max Unbraced Length | Comments |
|---------------------|----------|
| 1' | |

Lateral Connections

| Supports | Connector | Type/Model | Quantity | Connector Nailing |
|----------|-----------|----------------------------|----------|-------------------|
| Top | Nails | 8d (0.113" x 2 1/2") (Toe) | 2 | N/A |
| Base | Nails | 8d (0.113" x 2 1/2") (Toe) | 2 | N/A |

- Nailed connection at the top of the member is assumed to be nailed through the bottom 2x plate prior to placement of the top 2x of the double top plate assembly.

| Vertical Load | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|----------------|-----------------|-------------|-------------------|--------------------------------------------------------|
| 1 - Point (lb) | N/A | 2740 | 3534 | Linked from: Grid 6.2 (B.7-C) Flush Beam, Support 2 |

| Lateral Load | Location | Tributary Width | Wind (1.60) | Comments |
|-------------------|-------------|-----------------|-------------|----------|
| 1 - Uniform (PSF) | Full Length | N/A | 22.9 | |

- ASCE/SEI 7 Sec. 30.4: Exposure Category (B), Mean Roof Height (33'), Topographic Factor (1.0), Wind Directionality Factor (0.85), Basic Wind Speed (110), Risk Category(II), Wind Zone (4), GCpi (+/- 0.18), Effective Wind Area determined using full member span and trib. width.
- IBC Table 1604.3, footnote f: Deflection checks are performed using 42% of this lateral wind load.

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



3rd Floor Framing, Floor Joist 16' and Under
1 piece(s) 11 7/8" TJI® 110 @ 16" OC

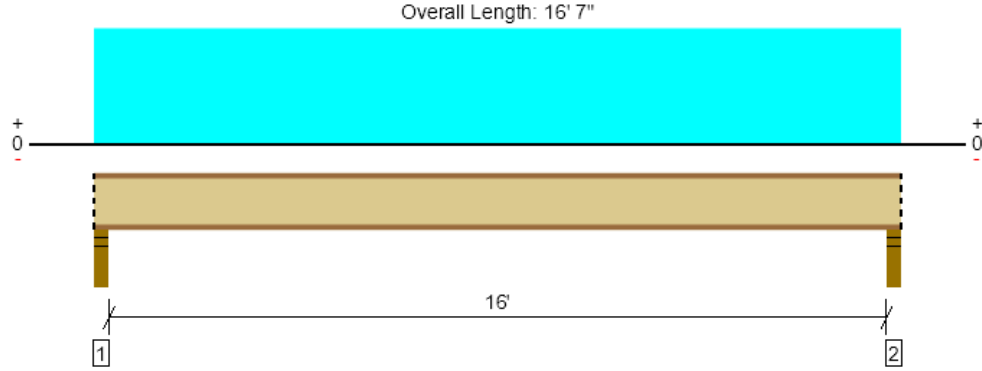

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|----------------|------|-----------------------------|
| Member Reaction (lbs) | 774 @ 2 1/2" | 1375 (3.50") | Passed (56%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 747 @ 3 1/2" | 1560 | Passed (48%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 3049 @ 8' 3 1/2" | 3160 | Passed (96%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.275 @ 8' 3 1/2" | 0.539 | Passed (L/704) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.482 @ 8' 3 1/2" | 0.808 | Passed (L/403) | -- | 1.0 D + 1.0 L (All Spans) |
| TJ-Pro™ Rating | 48 | 40 | Passed | -- | -- |

Member Length : 16' 7"
System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: 5/8" Gypsum ceiling.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.75" | 332 | 442 | 774 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.75" | 332 | 442 | 774 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 1" o/c | |
| Bottom Edge (Lu) | 16' 7" o/c | |

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

| Vertical Load | Location | Spacing | Dead (0.90) | Floor Live (1.00) | Comments |
|-------------------|-------------|---------|-------------|-------------------|--------------|
| 1 - Uniform (PSF) | 0 to 16' 7" | 16" | 30.0 | 40.0 | Default Load |

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |




8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H



MEMBER REPORT

PASSED

3rd Floor Framing, 8'-5" Landing Joists
1 piece(s) 2 x 12 HF No.2 @ 12" OC

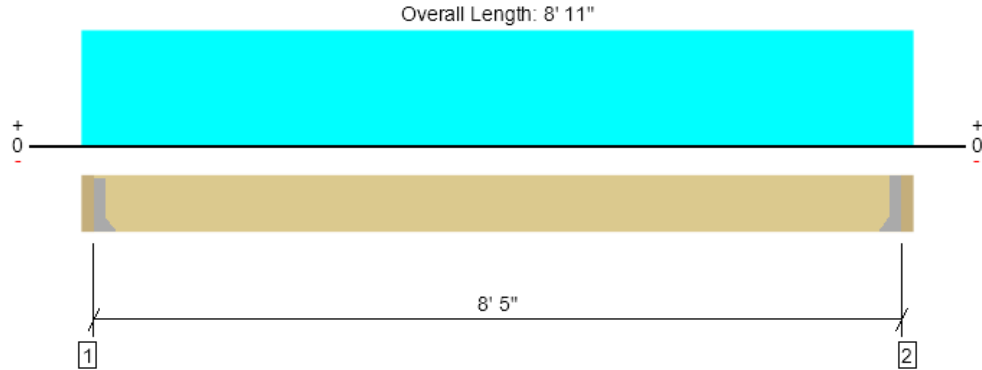

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|-------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 821 @ 3" | 911 (1.50") | Passed (90%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 638 @ 1' 2 1/4" | 1688 | Passed (38%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 1727 @ 4' 5 1/2" | 2577 | Passed (67%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.073 @ 4' 5 1/2" | 0.281 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.095 @ 4' 5 1/2" | 0.421 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| TJ-Pro™ Rating | N/A | N/A | N/A | -- | N/A |

Member Length : 8' 5"
System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------------------|----------------|---------------------|----------|-------------------------|------------|----------|-----------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Hanger on 11 1/4" LSL beam | 3.00" | Hanger ¹ | 1.50" | 201 | 669 | 869 | See note ¹ |
| 2 - Hanger on 11 1/4" LSL beam | 3.00" | Hanger ¹ | 1.50" | 201 | 669 | 869 | See note ¹ |

• At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger

• ¹ See Connector grid below for additional information and/or requirements.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 6' 4" o/c | |
| Bottom Edge (Lu) | 8' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

| Support | Model | Seat Length | Top Fasteners | Face Fasteners | Member Fasteners | Accessories |
|-----------------------|-------|-------------|---------------|----------------|------------------|-------------|
| 1 - Face Mount Hanger | LUS28 | 1.75" | N/A | 6-10dx1.5 | 3-10d | |
| 2 - Face Mount Hanger | LUS28 | 1.75" | N/A | 6-10dx1.5 | 3-10d | |

• Refer to manufacturer notes and instructions for proper installation and use of all connectors.

| Vertical Load | Location (Side) | Spacing | Dead (0.90) | Floor Live (1.00) | Comments |
|-------------------|-----------------|---------|-------------|-------------------|--------------|
| 1 - Uniform (PSF) | 0 to 8' 11" | 12" | 45.0 | 150.0 | Default Load |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Short Stair Stringers
1 piece(s) 4 x 12 HF No.2

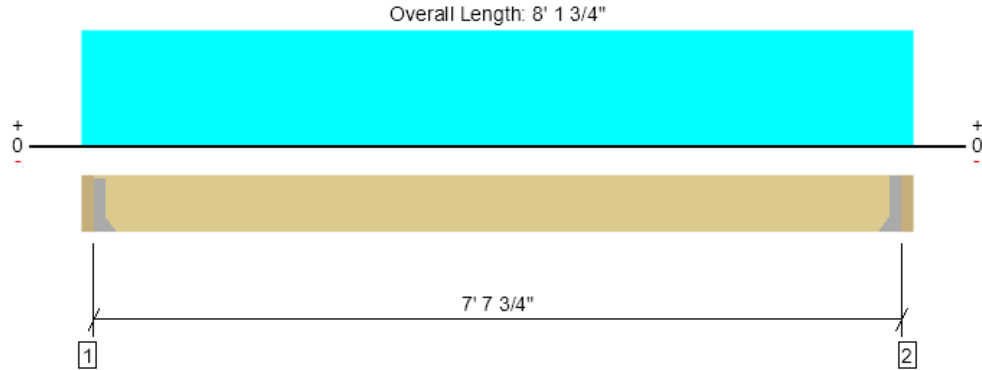

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1529 @ 3" | 2126 (1.50") | Passed (72%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1154 @ 1' 2 1/4" | 3938 | Passed (29%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 2923 @ 4' 7/8" | 5752 | Passed (51%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.043 @ 4' 7/8" | 0.191 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.057 @ 4' 7/8" | 0.382 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 7' 7 3/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------------------|----------------|---------------------|----------|-------------------------|------------|----------|-----------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Hanger on 11 1/4" GLB beam | 3.00" | Hanger ¹ | 1.50" | 405 | 1222 | 1627 | See note ¹ |
| 2 - Hanger on 11 1/4" GLB beam | 3.00" | Hanger ¹ | 1.50" | 405 | 1222 | 1627 | See note ¹ |

- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 7' 8" o/c | |
| Bottom Edge (Lu) | 7' 8" o/c | |

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

| Support | Model | Seat Length | Top Fasteners | Face Fasteners | Member Fasteners | Accessories |
|-----------------------|--------|-------------|---------------|----------------|------------------|-------------|
| 1 - Face Mount Hanger | LUS410 | 2.00" | N/A | 8-16d | 6-16d | |
| 2 - Face Mount Hanger | LUS410 | 2.00" | N/A | 8-16d | 6-16d | |

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 3" to 7' 10 3/4" | N/A | 10.0 | -- | |
| 1 - Uniform (PSF) | 0 to 8' 1 3/4" (Front) | 2' | 45.0 | 150.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Top Landing Beam
1 piece(s) 5 1/2" x 12" 24F-V4 DF Glulam

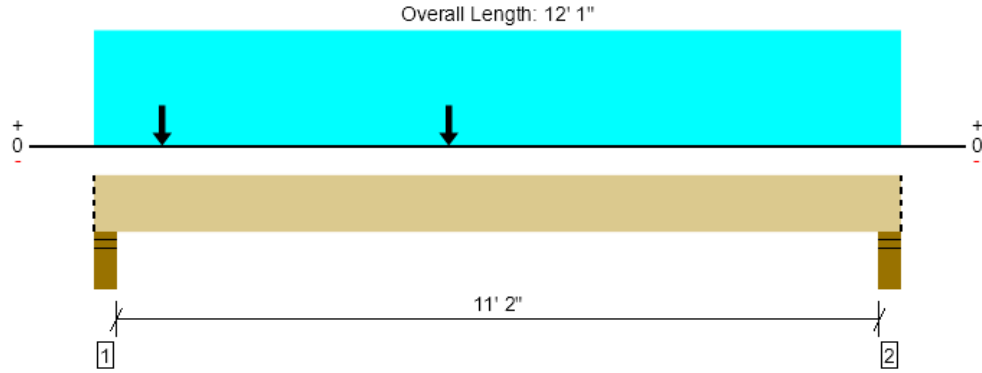

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|----------------------|---------------|----------------|------|-----------------------------|
| Member Reaction (lbs) | 8041 @ 4" | 12251 (5.50") | Passed (66%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 6022 @ 1' 5 1/2" | 11660 | Passed (52%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 20040 @ 5' 3 3/4" | 26400 | Passed (76%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.241 @ 5' 11 13/16" | 0.285 | Passed (L/569) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.319 @ 5' 11 3/4" | 0.571 | Passed (L/429) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 11' 5".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Member Length : 12' 1"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 5.50" | 5.50" | 3.61" | 1975 | 6067 | 8041 | Blocking |
| 2 - Stud wall - HF | 5.50" | 5.50" | 2.87" | 1567 | 4836 | 6402 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 12' 1" o/c | |
| Bottom Edge (Lu) | 12' 1" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|---------------------|-----------------|-------------|-------------------|-----------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 12' 1" | N/A | 16.0 | -- | |
| 1 - Uniform (PSF) | 0 to 12' 1" (Front) | 4' 8" | 45.0 | 150.0 | Default Load |
| 2 - Point (lb) | 1' 1/4" (Front) | N/A | 405 | 1222 | Linked from: Short Stair Stringers, Support 1 |
| 3 - Point (lb) | 5' 3 3/4" (Front) | N/A | 405 | 1222 | Linked from: Short Stair Stringers, Support 1 |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, 4' Mid Landing Joists
1 piece(s) 2 x 8 HF No.2 @ 16" OC

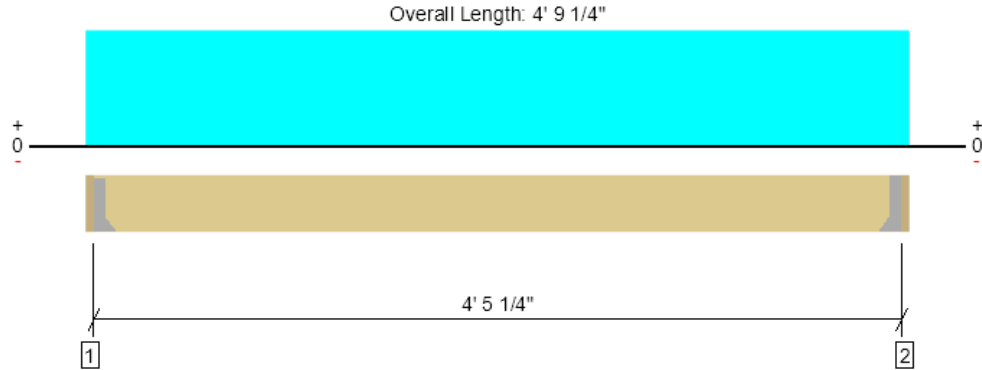

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|-------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 577 @ 2" | 911 (1.50") | Passed (63%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 420 @ 9 1/4" | 1088 | Passed (39%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 640 @ 2' 4 5/8" | 1284 | Passed (50%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.028 @ 2' 4 5/8" | 0.148 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.037 @ 2' 4 5/8" | 0.222 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| TJ-Pro™ Rating | N/A | N/A | N/A | -- | N/A |

Member Length : 4' 5 1/4"
System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|-------------------------------|----------------|---------------------|----------|-------------------------|------------|----------|-----------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Hanger on 7 1/4" LSL beam | 2.00" | Hanger ¹ | 1.50" | 143 | 477 | 620 | See note ¹ |
| 2 - Hanger on 7 1/4" LSL beam | 2.00" | Hanger ¹ | 1.50" | 143 | 477 | 620 | See note ¹ |

• At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger

• ¹ See Connector grid below for additional information and/or requirements.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 4' 5" o/c | |
| Bottom Edge (Lu) | 4' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

| Support | Model | Seat Length | Top Fasteners | Face Fasteners | Member Fasteners | Accessories |
|-----------------------|-------|-------------|---------------|----------------|------------------|-------------|
| 1 - Face Mount Hanger | LU26 | 1.50" | N/A | 6-10d | 4-10dx1.5 | |
| 2 - Face Mount Hanger | LU26 | 1.50" | N/A | 6-10d | 4-10dx1.5 | |

• Refer to manufacturer notes and instructions for proper installation and use of all connectors.

| Vertical Load | Location (Side) | Spacing | Dead (0.90) | Floor Live (1.00) | Comments |
|-------------------|-----------------|---------|-------------|-------------------|--------------|
| 1 - Uniform (PSF) | 0 to 4' 9 1/4" | 16" | 45.0 | 150.0 | Default Load |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Mid Landing Inner Beam
1 piece(s) 5 1/2" x 12" 24F-V4 DF Glulam

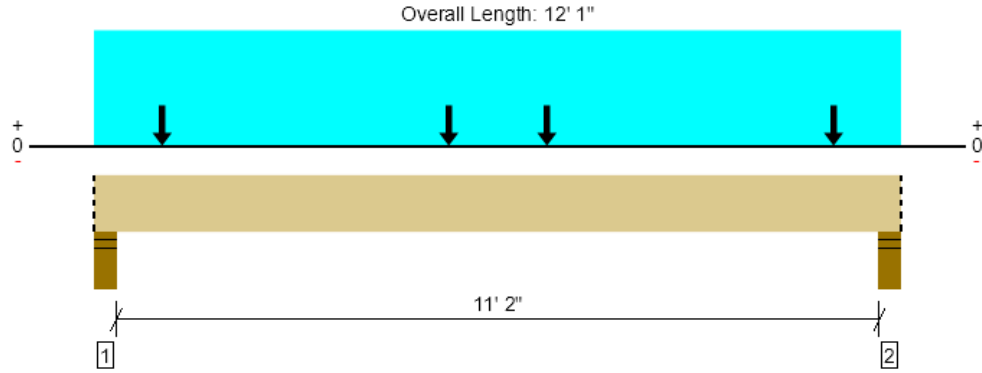

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|---------------|----------------|------|-----------------------------|
| Member Reaction (lbs) | 6299 @ 11' 9" | 12251 (5.50") | Passed (51%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 4890 @ 1' 5 1/2" | 11660 | Passed (42%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 17407 @ 6' 7/16" | 26400 | Passed (66%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.207 @ 6' 1/2" | 0.285 | Passed (L/663) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.276 @ 6' 1/2" | 0.571 | Passed (L/496) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 11' 5".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Member Length : 12' 1"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 5.50" | 5.50" | 2.83" | 1586 | 4707 | 6293 | Blocking |
| 2 - Stud wall - HF | 5.50" | 5.50" | 2.83" | 1587 | 4712 | 6299 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 12' 1" o/c | |
| Bottom Edge (Lu) | 12' 1" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|---------------------|-----------------|-------------|-------------------|-----------------------------------------------|
| 0 - Self Weight (PLF) | 0 to 12' 1" | N/A | 16.0 | -- | |
| 1 - Uniform (PSF) | 0 to 12' 1" (Front) | 2' 6" | 45.0 | 150.0 | Default Load |
| 2 - Point (lb) | 1' 1/4" (Front) | N/A | 405 | 1222 | Linked from: Short Stair Stringers, Support 1 |
| 3 - Point (lb) | 5' 3 3/4" (Front) | N/A | 405 | 1222 | Linked from: Short Stair Stringers, Support 1 |
| 4 - Point (lb) | 6' 9 3/8" (Front) | N/A | 405 | 1222 | Linked from: Short Stair Stringers, Support 1 |
| 5 - Point (lb) | 11' 7/8" (Front) | N/A | 405 | 1222 | Linked from: Short Stair Stringers, Support 1 |

- Side loads are assumed to not induce cross-grain tension.


| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator



| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



3rd Floor Framing, Mid Landing Outer Beam
1 piece(s) 3 1/2" x 10 1/2" 24F-V4 DF Glulam

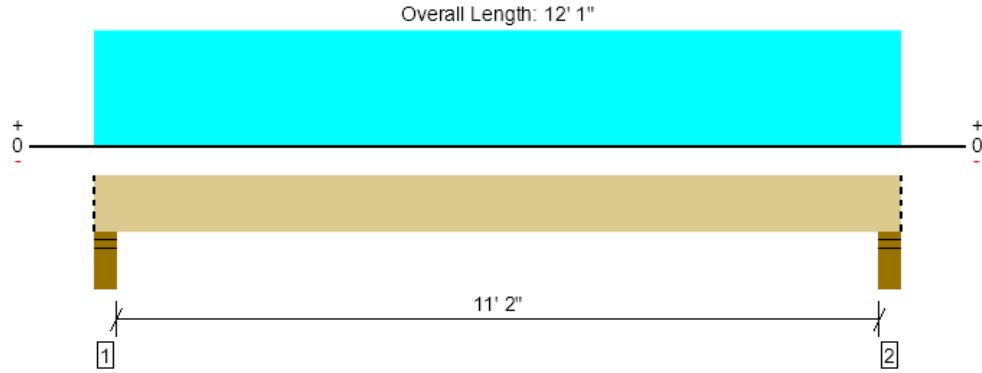

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|----------------|------|-----------------------------|
| Member Reaction (lbs) | 2999 @ 4" | 7796 (5.50") | Passed (38%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 2337 @ 1' 4" | 6493 | Passed (36%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 8088 @ 6' 1/2" | 12863 | Passed (63%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.236 @ 6' 1/2" | 0.285 | Passed (L/581) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.312 @ 6' 1/2" | 0.571 | Passed (L/439) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 11' 5".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Member Length : 12' 1"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 5.50" | 5.50" | 2.12" | 734 | 2266 | 2999 | Blocking |
| 2 - Stud wall - HF | 5.50" | 5.50" | 2.12" | 734 | 2266 | 2999 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 12' 1" o/c | |
| Bottom Edge (Lu) | 12' 1" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|---------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 12' 1" | N/A | 8.9 | -- | |
| 1 - Uniform (PSF) | 0 to 12' 1" (Front) | 2' 6" | 45.0 | 150.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, 8'-10" Deck Joist
1 piece(s) 2 x 12 HF No.2 @ 16" OC

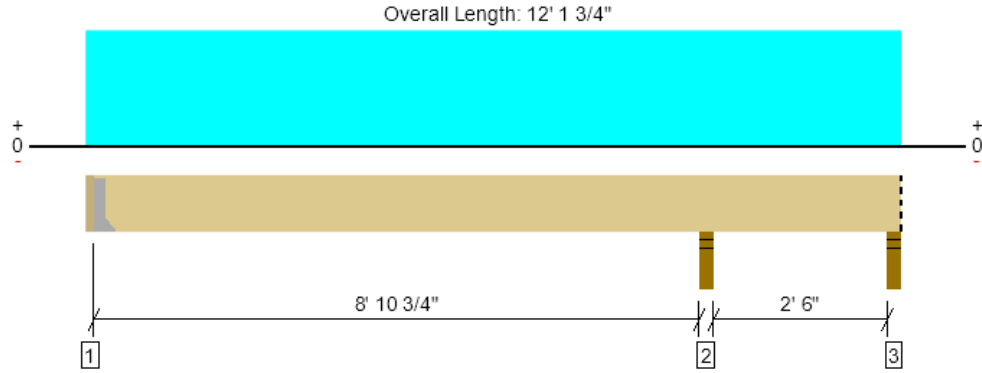

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1168 @ 9' 2 1/2" | 2126 (3.50") | Passed (55%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 520 @ 8' 1 1/2" | 1688 | Passed (31%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | -968 @ 9' 2 1/2" | 2577 | Passed (38%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.028 @ 4' 2 7/8" | 0.301 | Passed (L/999+) | -- | 1.0 D + 1.0 L (Alt Spans) |
| Total Load Defl. (in) | 0.042 @ 4' 2 3/4" | 0.452 | Passed (L/999+) | -- | 1.0 D + 1.0 L (Alt Spans) |
| TJ-Pro™ Rating | N/A | N/A | N/A | -- | N/A |

Member Length : 11' 11 3/4"
System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- 285 lbs uplift at support located at 11' 11 1/4". Strapping or other restraint may be required.
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|-------------------------------|----------------|---------------------|----------|-------------------------|------------|----------|-----------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Hanger on 11 1/4" HF beam | 2.00" | Hanger ¹ | 1.50" | 152 | 306 | 457 | See note ¹ |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.92" | 389 | 779 | 1168 | None |
| 3 - Stud wall - HF | 3.50" | 3.50" | 1.50" | -55 | 120/-230 | 64/-285 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 12' o/c | |
| Bottom Edge (Lu) | 12' o/c | |

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

| Support | Model | Seat Length | Top Fasteners | Face Fasteners | Member Fasteners | Accessories |
|-----------------------|-------|-------------|---------------|----------------|------------------|-------------|
| 1 - Face Mount Hanger | LUS28 | 1.75" | N/A | 6-10dx1.5 | 3-10d | |

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

| Vertical Load | Location (Side) | Spacing | Dead (0.90) | Floor Live (1.00) | Comments |
|-------------------|-----------------|---------|-------------|-------------------|--------------|
| 1 - Uniform (PSF) | 0 to 12' 1 3/4" | 16" | 30.0 | 60.0 | Default Load |


| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator



| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



3rd Floor Framing, 6' Window Header
1 piece(s) 4 x 10 DF No.2

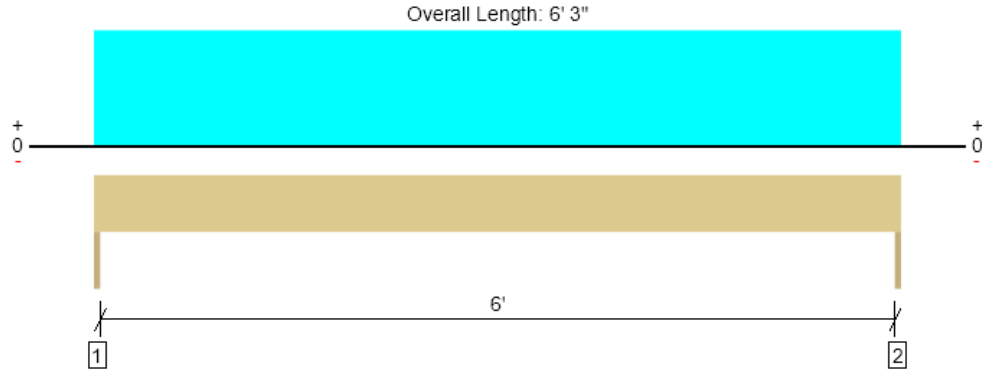

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2272 @ 0 | 3281 (1.50") | Passed (69%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1621 @ 10 3/4" | 3885 | Passed (42%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 3550 @ 3' 1 1/2" | 4492 | Passed (79%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.031 @ 3' 1 1/2" | 0.208 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.068 @ 3' 1 1/2" | 0.313 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 6' 3"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1215 | 1057 | 2272 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1215 | 1057 | 2272 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 6' 3" o/c | |
| Bottom Edge (Lu) | 6' 3" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|----------|
| 0 - Self Weight (PLF) | 0 to 6' 3" | N/A | 8.2 | -- | |
| 1 - Uniform (PSF) | 0 to 6' 3" | 6' 7" | 30.0 | 40.0 | Floor |
| 2 - Uniform (PLF) | 0 to 6' 3" | N/A | 108.0 | - | Wall |
| 3 - Uniform (PSF) | 0 to 6' 3" | 3' | 25.0 | 25.0 | Roof |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 2 (B.6-B.8) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

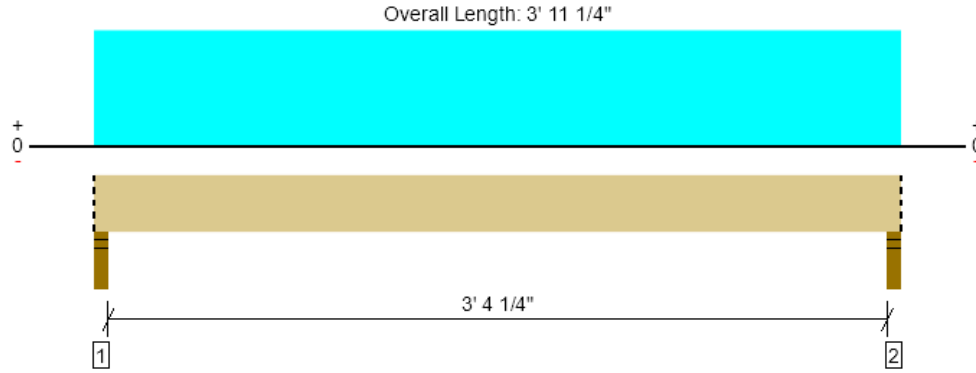

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1409 @ 2" | 4961 (3.50") | Passed (28%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 492 @ 1' 3 3/8" | 7343 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1163 @ 1' 11 5/8" | 16452 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.002 @ 1' 11 5/8" | 0.090 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.003 @ 1' 11 5/8" | 0.180 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 3' 11 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 3' 7 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 615 | 794 | 1409 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 615 | 794 | 1409 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 11" o/c | |
| Bottom Edge (Lu) | 3' 11" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|-------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 3' 11 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 11 1/4" (Front) | 10' 1" | 30.0 | 40.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 12 (B.6-B.8) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

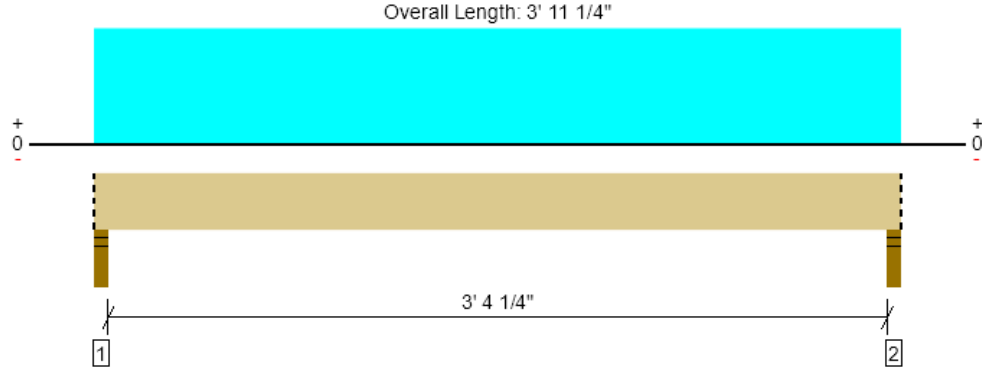

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1409 @ 2" | 4961 (3.50") | Passed (28%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 492 @ 1' 3 3/8" | 7343 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1163 @ 1' 11 5/8" | 16452 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.002 @ 1' 11 5/8" | 0.090 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.003 @ 1' 11 5/8" | 0.180 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 3' 11 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 3' 7 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 615 | 794 | 1409 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 615 | 794 | 1409 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 11" o/c | |
| Bottom Edge (Lu) | 3' 11" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|-------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 3' 11 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 11 1/4" (Front) | 10' 1" | 30.0 | 40.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 3.1 (B.6-B.8) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

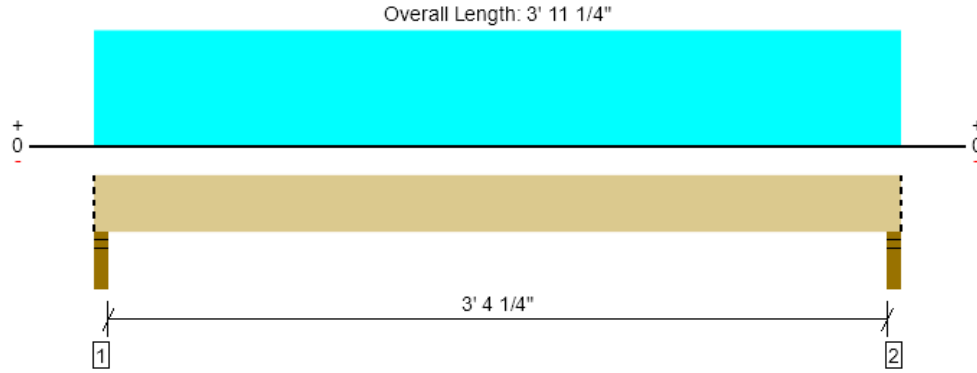

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1398 @ 2" | 4961 (3.50") | Passed (28%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 488 @ 1' 3 3/8" | 7343 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1153 @ 1' 11 5/8" | 16452 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.002 @ 1' 11 5/8" | 0.090 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.003 @ 1' 11 5/8" | 0.180 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 3' 11 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 3' 7 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 611 | 788 | 1398 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 611 | 788 | 1398 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 11" o/c | |
| Bottom Edge (Lu) | 3' 11" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|-------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 3' 11 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 11 1/4" (Front) | 10' | 30.0 | 40.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 10.9 (B.6-B.8) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

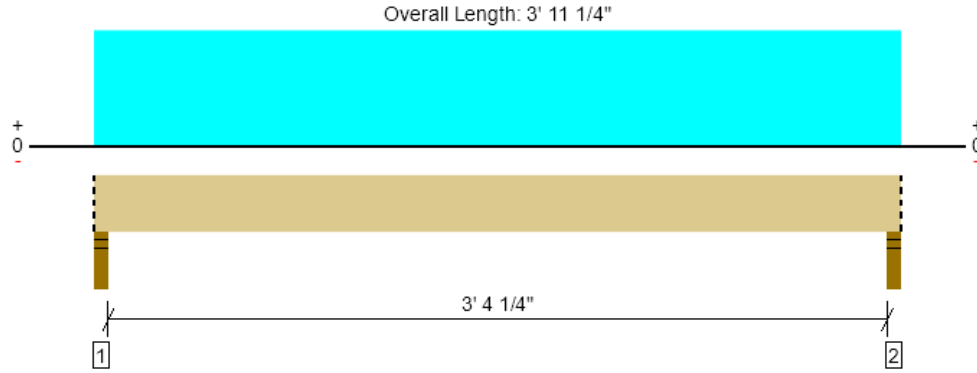

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1398 @ 2" | 4961 (3.50") | Passed (28%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 488 @ 1' 3 3/8" | 7343 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1153 @ 1' 11 5/8" | 16452 | Passed (7%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.002 @ 1' 11 5/8" | 0.090 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.003 @ 1' 11 5/8" | 0.180 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 3' 11 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 3' 7 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 611 | 788 | 1398 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 611 | 788 | 1398 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 11" o/c | |
| Bottom Edge (Lu) | 3' 11" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|-------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 3' 11 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 11 1/4" (Front) | 10' | 30.0 | 40.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |




8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H



MEMBER REPORT

PASSED

3rd Floor Framing, Grid 5.2 (B.6-B.8) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

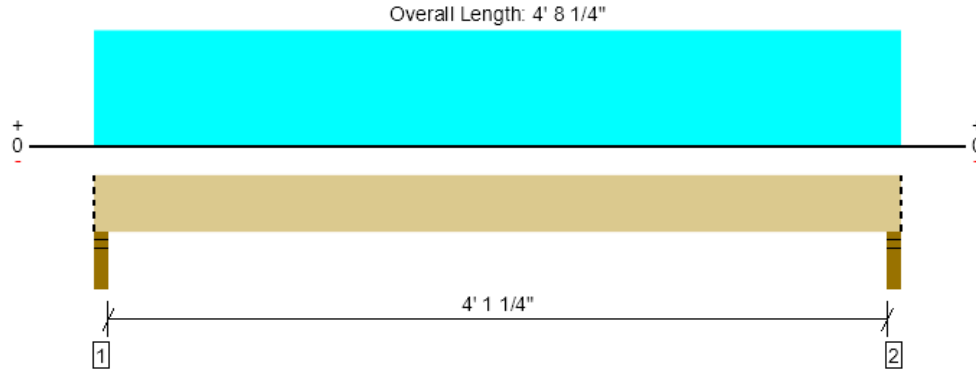

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1664 @ 2" | 4961 (3.50") | Passed (34%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 754 @ 1' 3 3/8" | 7343 | Passed (10%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1683 @ 2' 4 1/8" | 16452 | Passed (10%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.004 @ 2' 4 1/8" | 0.109 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.007 @ 2' 4 1/8" | 0.218 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 4' 8 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 4' 4 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 727 | 938 | 1664 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 727 | 938 | 1664 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 4' 8" o/c | |
| Bottom Edge (Lu) | 4' 8" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 4' 8 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 4' 8 1/4" (Front) | 10' | 30.0 | 40.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |




8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H



MEMBER REPORT

PASSED

3rd Floor Framing, Grid 8.8 (B.6-B.8) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

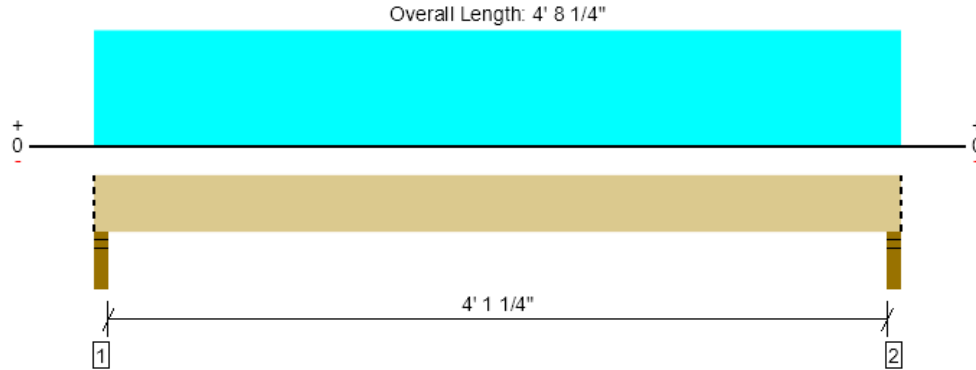

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1664 @ 2" | 4961 (3.50") | Passed (34%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 754 @ 1' 3 3/8" | 7343 | Passed (10%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1683 @ 2' 4 1/8" | 16452 | Passed (10%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.004 @ 2' 4 1/8" | 0.109 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.007 @ 2' 4 1/8" | 0.218 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 4' 8 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 4' 4 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 727 | 938 | 1664 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 727 | 938 | 1664 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 4' 8" o/c | |
| Bottom Edge (Lu) | 4' 8" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 4' 8 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 4' 8 1/4" (Front) | 10' | 30.0 | 40.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 5.2 (B.8-B.9) Bathroom Door Header
1 piece(s) 4 x 8 DF No.2

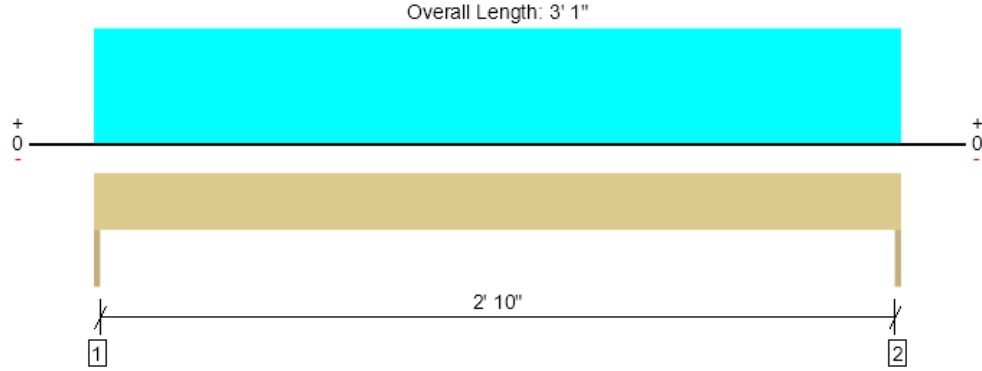

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1089 @ 0 | 3281 (1.50") | Passed (33%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 574 @ 8 3/4" | 3045 | Passed (19%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 839 @ 1' 6 1/2" | 2989 | Passed (28%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.005 @ 1' 6 1/2" | 0.103 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.008 @ 1' 6 1/2" | 0.154 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 1"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 472 | 617 | 1089 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 472 | 617 | 1089 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 1" o/c | |
| Bottom Edge (Lu) | 3' 1" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 3' 1" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 1" | 10' | 30.0 | 40.0 | Default Load |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 8.8 (B.8-B.9) Bathroom Door Header
1 piece(s) 4 x 8 DF No.2

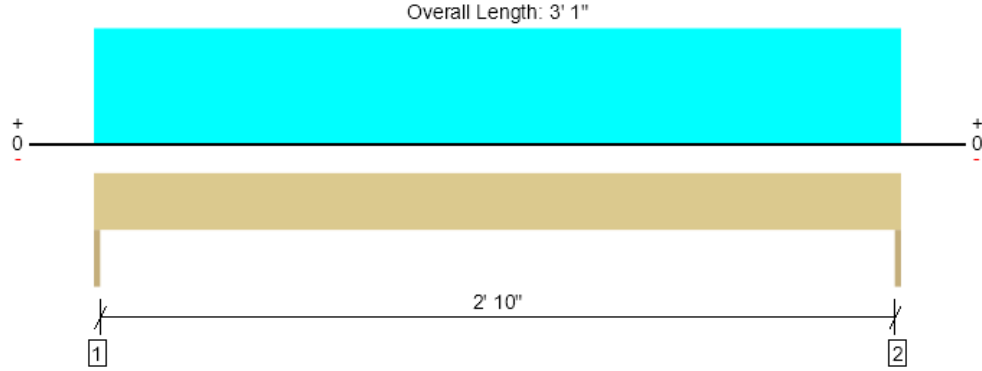

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1089 @ 0 | 3281 (1.50") | Passed (33%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 574 @ 8 3/4" | 3045 | Passed (19%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 839 @ 1' 6 1/2" | 2989 | Passed (28%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.005 @ 1' 6 1/2" | 0.103 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.008 @ 1' 6 1/2" | 0.154 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 1"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 472 | 617 | 1089 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 472 | 617 | 1089 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 1" o/c | |
| Bottom Edge (Lu) | 3' 1" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 3' 1" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 1" | 10' | 30.0 | 40.0 | Default Load |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 6.2 (B.4-B.5) Bedroom Door Header
1 piece(s) 4 x 8 DF No.2

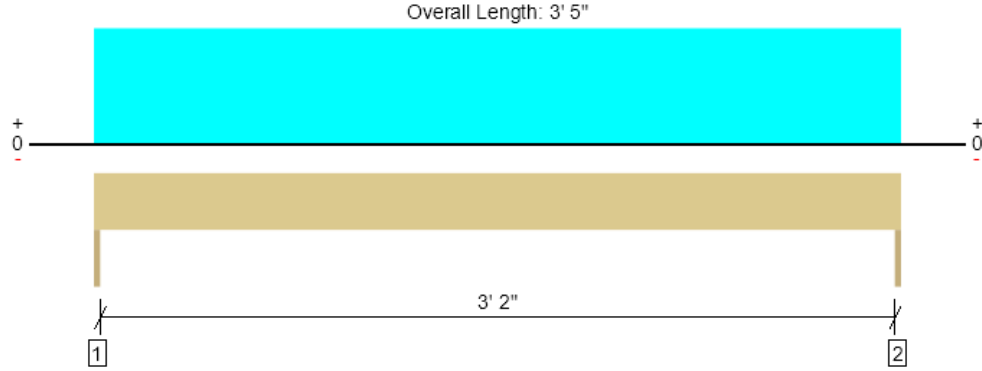

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1207 @ 0 | 3281 (1.50") | Passed (37%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 692 @ 8 3/4" | 3045 | Passed (23%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 1031 @ 1' 8 1/2" | 2989 | Passed (34%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.007 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.012 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 523 | 683 | 1207 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 523 | 683 | 1207 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 10' | 30.0 | 40.0 | Default Load |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 7.8 (B.4-B.5) Bedroom Door Header
1 piece(s) 4 x 8 DF No.2

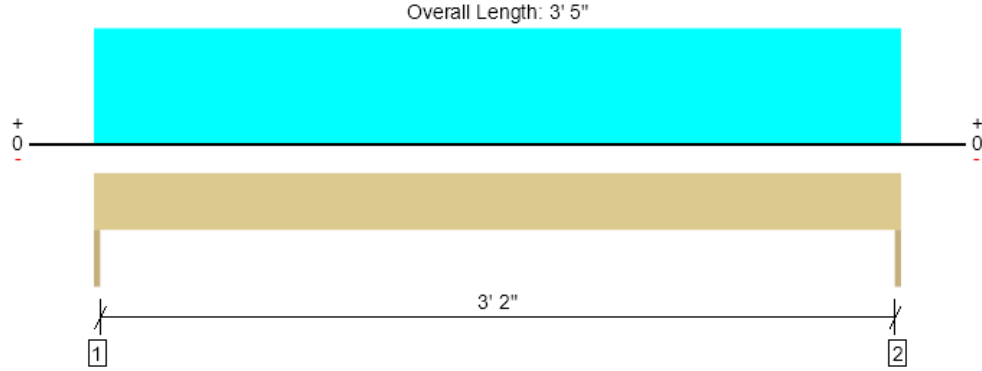

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1207 @ 0 | 3281 (1.50") | Passed (37%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 692 @ 8 3/4" | 3045 | Passed (23%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 1031 @ 1' 8 1/2" | 2989 | Passed (34%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.007 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.012 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 523 | 683 | 1207 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 523 | 683 | 1207 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 10' | 30.0 | 40.0 | Default Load |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 6.2 (B.7-C) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

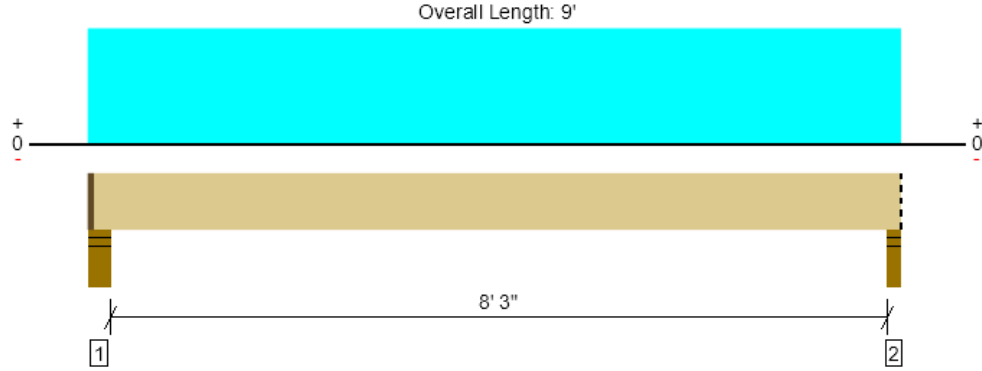

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 3136 @ 8' 10" | 4961 (3.50") | Passed (63%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 2226 @ 1' 5 3/8" | 7343 | Passed (30%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 6413 @ 4' 7" | 16452 | Passed (39%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.053 @ 4' 7" | 0.213 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.095 @ 4' 7" | 0.425 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 8' 10 1/2"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 8' 6".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 5.50" | 4.00" | 2.23" | 1420 | 1833 | 3253 | 1 1/2" Rim Board |
| 2 - Stud wall - HF | 3.50" | 3.50" | 2.21" | 1370 | 1767 | 3136 | Blocking |

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 8' 11" o/c | |
| Bottom Edge (Lu) | 8' 11" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|-----------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 1 1/2" to 9' | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 9' (Front) | 10' | 30.0 | 40.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 7.8 (B.7-C) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

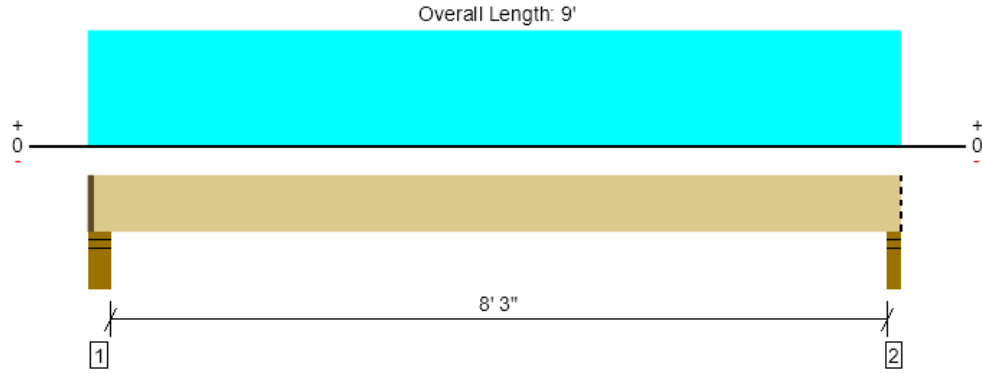

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 3136 @ 8' 10" | 4961 (3.50") | Passed (63%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 2226 @ 1' 5 3/8" | 7343 | Passed (30%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 6413 @ 4' 7" | 16452 | Passed (39%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.053 @ 4' 7" | 0.213 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.095 @ 4' 7" | 0.425 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 8' 10 1/2"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 8' 6".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 5.50" | 4.00" | 2.23" | 1420 | 1833 | 3253 | 1 1/2" Rim Board |
| 2 - Stud wall - HF | 3.50" | 3.50" | 2.21" | 1370 | 1767 | 3136 | Blocking |

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 8' 11" o/c | |
| Bottom Edge (Lu) | 8' 11" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|-----------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 1 1/2" to 9' | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 9' (Front) | 10' | 30.0 | 40.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 2.3 (D-D.1) Bedroom Door Header
1 piece(s) 4 x 8 DF No.2

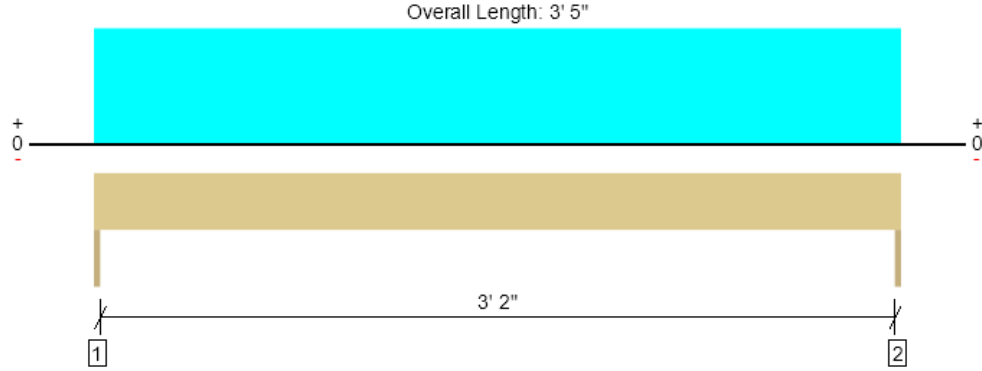

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 988 @ 0 | 3281 (1.50") | Passed (30%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 566 @ 8 3/4" | 3045 | Passed (19%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 844 @ 1' 8 1/2" | 2989 | Passed (28%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.006 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.010 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 430 | 558 | 988 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 430 | 558 | 988 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 8' 2" | 30.0 | 40.0 | Default Load |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 11.7 (D-D.1) Bedroom Door Header
1 piece(s) 4 x 8 DF No.2

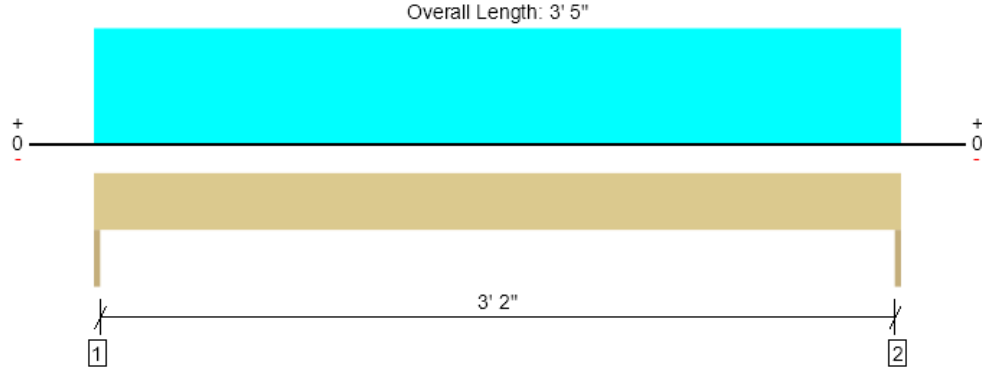

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 988 @ 0 | 3281 (1.50") | Passed (30%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 566 @ 8 3/4" | 3045 | Passed (19%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 844 @ 1' 8 1/2" | 2989 | Passed (28%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.006 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.010 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 430 | 558 | 988 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 430 | 558 | 988 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 8' 2" | 30.0 | 40.0 | Default Load |

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.woyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |




8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H



MEMBER REPORT

PASSED

3rd Floor Framing, Grid 2.7 (D.2-D.4) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

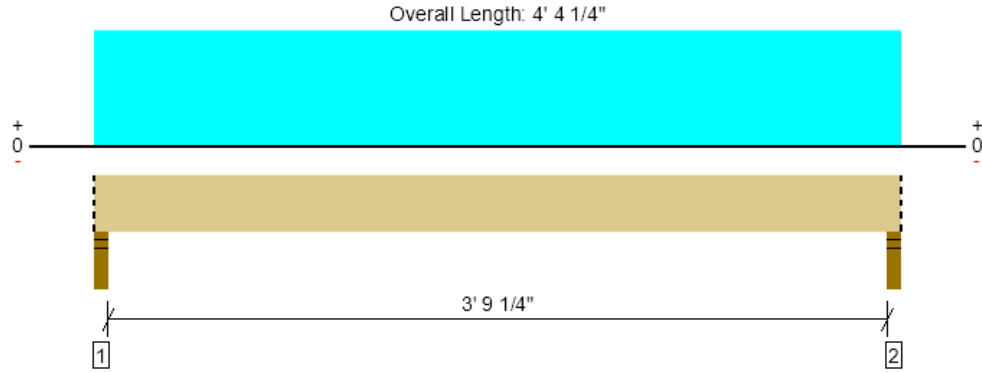

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1736 @ 2" | 4961 (3.50") | Passed (35%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 715 @ 1' 3 3/8" | 7343 | Passed (10%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1612 @ 2' 2 1/8" | 16452 | Passed (10%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.003 @ 2' 2 1/8" | 0.101 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.005 @ 2' 2 1/8" | 0.201 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 4' 4 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 4' 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 757 | 980 | 1736 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 757 | 980 | 1736 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 4' 4" o/c | |
| Bottom Edge (Lu) | 4' 4" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 4' 4 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 4' 4 1/4" (Front) | 11' 3" | 30.0 | 40.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |




8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H



MEMBER REPORT

PASSED

3rd Floor Framing, Grid 11.3 (D.2-D.4) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

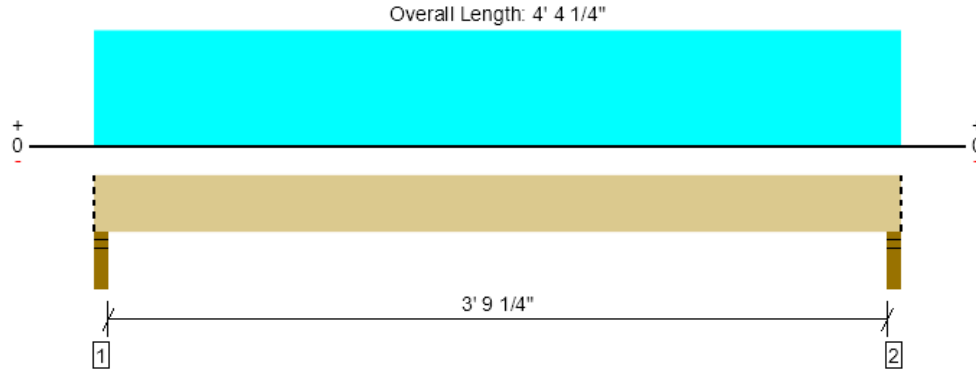

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1736 @ 2" | 4961 (3.50") | Passed (35%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 715 @ 1' 3 3/8" | 7343 | Passed (10%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 1612 @ 2' 2 1/8" | 16452 | Passed (10%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.003 @ 2' 2 1/8" | 0.101 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.005 @ 2' 2 1/8" | 0.201 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 4' 4 1/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 4' 1/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 757 | 980 | 1736 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 1.50" | 757 | 980 | 1736 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 4' 4" o/c | |
| Bottom Edge (Lu) | 4' 4" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 4' 4 1/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 4' 4 1/4" (Front) | 11' 3" | 30.0 | 40.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |




8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H



MEMBER REPORT

PASSED

3rd Floor Framing, Grid 5.6 (D-D.3) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

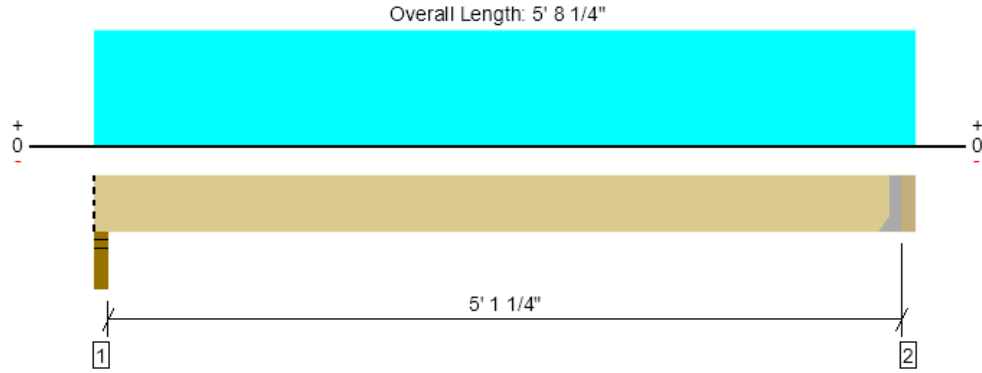

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2101 @ 5' 4 3/4" | 3413 (1.50") | Passed (62%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1306 @ 4' 4 7/8" | 7343 | Passed (18%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 2746 @ 2' 9 3/8" | 16452 | Passed (17%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.009 @ 2' 9 3/8" | 0.131 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.015 @ 2' 9 3/8" | 0.261 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 5' 4 3/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 5' 2 3/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------------------|----------------|---------------------|----------|-------------------------|------------|----------|-----------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.58" | 974 | 1261 | 2235 | Blocking |
| 2 - Hanger on 11 7/8" LSL beam | 3.50" | Hanger ¹ | 1.50" | 1015 | 1318 | 2332 | See note ¹ |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 5' 5" o/c | |
| Bottom Edge (Lu) | 5' 5" o/c | |

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

| Support | Model | Seat Length | Top Fasteners | Face Fasteners | Member Fasteners | Accessories |
|-----------------------|--------|-------------|---------------|----------------|------------------|-------------|
| 2 - Face Mount Hanger | LUS414 | 2.00" | N/A | 10-16d | 6-16d | |

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 5' 4 3/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 5' 8 1/4" (Front) | 11' 4" | 30.0 | 40.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |




8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator



| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



3rd Floor Framing, Grid 8.4 (D-D.3) Flush Beam
1 piece(s) 3 1/2" x 11 7/8" 24F-V4 DF Glulam

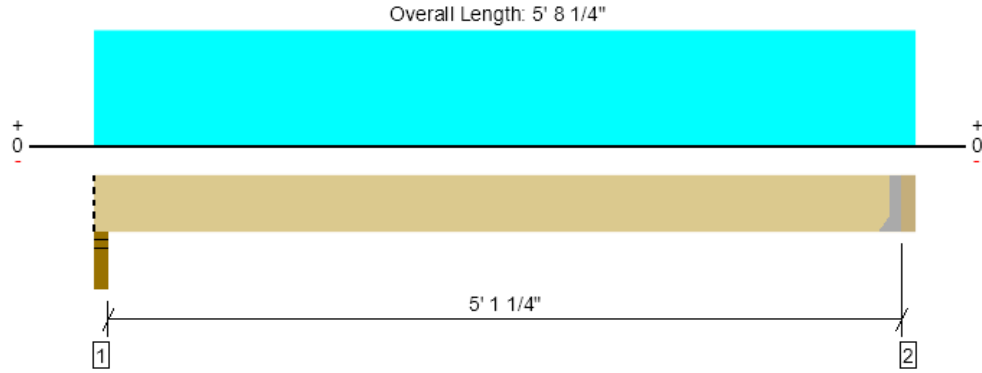

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2101 @ 5' 4 3/4" | 3413 (1.50") | Passed (62%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 1306 @ 4' 4 7/8" | 7343 | Passed (18%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Pos Moment (Ft-lbs) | 2746 @ 2' 9 3/8" | 16452 | Passed (17%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.009 @ 2' 9 3/8" | 0.131 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.015 @ 2' 9 3/8" | 0.261 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

Member Length : 5' 4 3/4"
System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 5' 2 3/4".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------------------|----------------|---------------------|----------|-------------------------|------------|----------|-----------------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 1.58" | 974 | 1261 | 2235 | Blocking |
| 2 - Hanger on 11 7/8" LSL beam | 3.50" | Hanger ¹ | 1.50" | 1015 | 1318 | 2332 | See note ¹ |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 5' 5" o/c | |
| Bottom Edge (Lu) | 5' 5" o/c | |

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

| Support | Model | Seat Length | Top Fasteners | Face Fasteners | Member Fasteners | Accessories |
|-----------------------|--------|-------------|---------------|----------------|------------------|-------------|
| 2 - Face Mount Hanger | LUS414 | 2.00" | N/A | 10-16d | 6-16d | |

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 5' 4 3/4" | N/A | 10.1 | -- | |
| 1 - Uniform (PSF) | 0 to 5' 8 1/4" (Front) | 11' 4" | 30.0 | 40.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.


| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator



| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



3rd Floor Framing, Grid 6 (D.5-D.6) Bedroom Door Header
1 piece(s) 4 x 8 DF No.2

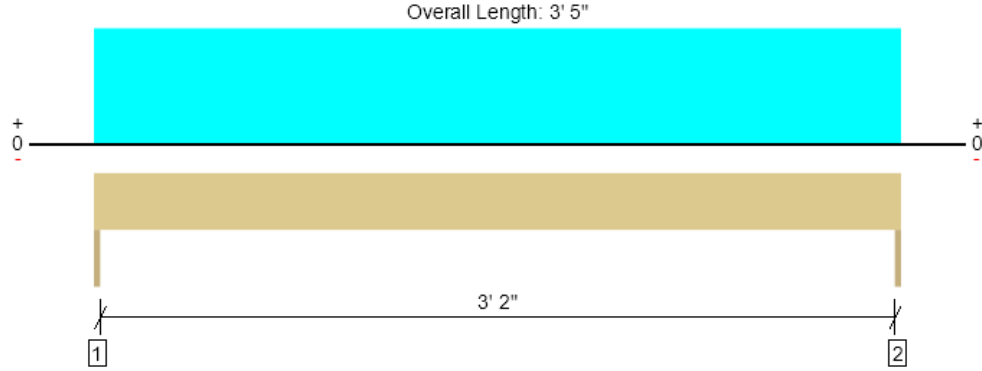

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1366 @ 0 | 3281 (1.50") | Passed (42%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 783 @ 8 3/4" | 3045 | Passed (26%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 1167 @ 1' 8 1/2" | 2989 | Passed (39%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.008 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.014 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 592 | 774 | 1366 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 592 | 774 | 1366 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 11' 4" | 30.0 | 40.0 | Default Load |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

3rd Floor Framing, Grid 8 (D.5-D.6) Bedroom Door Header
1 piece(s) 4 x 8 DF No.2

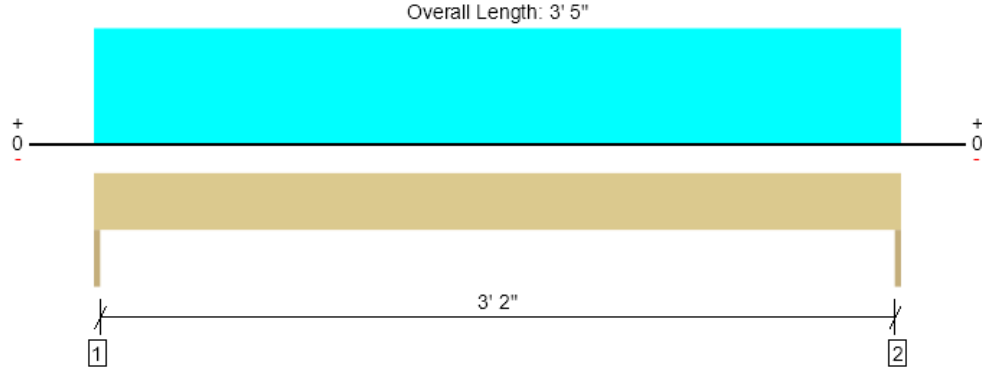

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 1366 @ 0 | 3281 (1.50") | Passed (42%) | -- | 1.0 D + 1.0 L (All Spans) |
| Shear (lbs) | 783 @ 8 3/4" | 3045 | Passed (26%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Moment (Ft-lbs) | 1167 @ 1' 8 1/2" | 2989 | Passed (39%) | 1.00 | 1.0 D + 1.0 L (All Spans) |
| Live Load Defl. (in) | 0.008 @ 1' 8 1/2" | 0.114 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |
| Total Load Defl. (in) | 0.014 @ 1' 8 1/2" | 0.171 | Passed (L/999+) | -- | 1.0 D + 1.0 L (All Spans) |

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Member Length : 3' 5"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------------|----------|-------------|
| | Total | Available | Required | Dead | Floor Live | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 592 | 774 | 1366 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 592 | 774 | 1366 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 3' 5" o/c | |
| Bottom Edge (Lu) | 3' 5" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Floor Live (1.00) | Comments |
|-----------------------|------------|-----------------|-------------|-------------------|--------------|
| 0 - Self Weight (PLF) | 0 to 3' 5" | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 3' 5" | 11' 4" | 30.0 | 40.0 | Default Load |

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

Roof Framing, Grid D.7 Entry Roof Beam
1 piece(s) 3 1/2" x 10 1/2" 24F-V4 DF Glulam

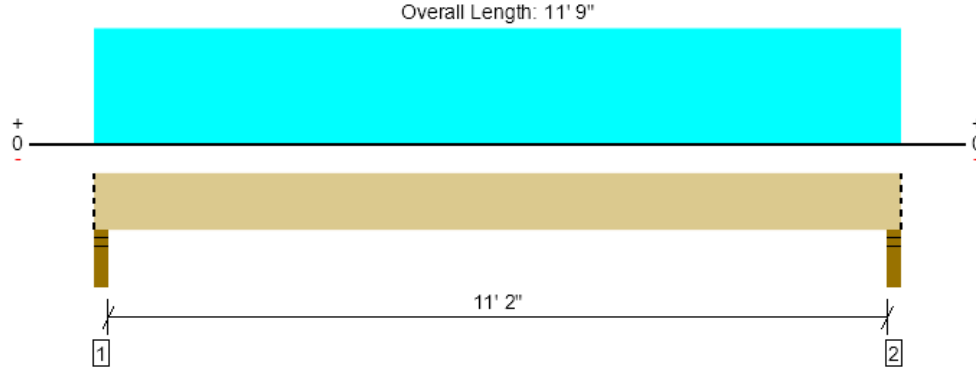

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|--------------|----------------|------|-----------------------------|
| Member Reaction (lbs) | 5084 @ 2" | 4961 (3.50") | Passed (102%) | -- | 1.0 D + 1.0 S (All Spans) |
| Shear (lbs) | 4075 @ 1' 2" | 7466 | Passed (55%) | 1.15 | 1.0 D + 1.0 S (All Spans) |
| Pos Moment (Ft-lbs) | 14099 @ 5' 10 1/2" | 14792 | Passed (95%) | 1.15 | 1.0 D + 1.0 S (All Spans) |
| Live Load Defl. (in) | 0.269 @ 5' 10 1/2" | 0.571 | Passed (L/509) | -- | 1.0 D + 1.0 S (All Spans) |
| Total Load Defl. (in) | 0.545 @ 5' 10 1/2" | 0.761 | Passed (L/252) | -- | 1.0 D + 1.0 S (All Spans) |

Member Length : 11' 9"
System : Roof
Member Type : Drop Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD
Member Pitch : 0.25/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 11' 5".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------|----------|-------------|
| | Total | Available | Required | Dead | Snow | Factored | |
| 1 - Stud wall - HF | 3.50" | 3.50" | 3.59" | 2569 | 2515 | 5084 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 3.59" | 2569 | 2515 | 5084 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 9' 10" o/c | |
| Bottom Edge (Lu) | 11' 9" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Snow (1.15) | Comments |
|-----------------------|---------------------|-----------------|-------------|-------------|--------------|
| 0 - Self Weight (PLF) | 0 to 11' 9" | N/A | 8.9 | -- | |
| 1 - Uniform (PSF) | 0 to 11' 9" (Front) | 17' 1 1/2" | 25.0 | 25.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H

Roof Framing, Grid A 7'-3" Deck Roof Beam
1 piece(s) 3 1/2" x 7 1/2" 24F-V4 DF Glulam

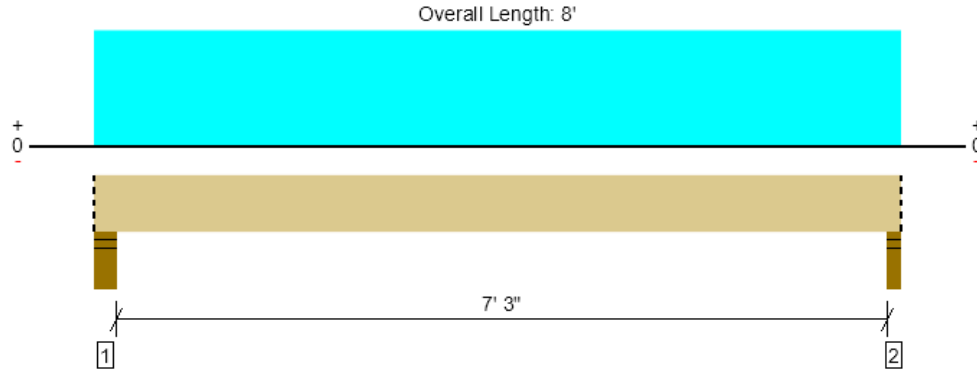

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|----------------|------|-----------------------------|
| Member Reaction (lbs) | 3257 @ 7' 10" | 4961 (3.50") | Passed (66%) | -- | 1.0 D + 1.0 S (All Spans) |
| Shear (lbs) | 2495 @ 1' 1" | 5333 | Passed (47%) | 1.15 | 1.0 D + 1.0 S (All Spans) |
| Pos Moment (Ft-lbs) | 5847 @ 4' 1" | 7547 | Passed (77%) | 1.15 | 1.0 D + 1.0 S (All Spans) |
| Live Load Defl. (in) | 0.133 @ 4' 1" | 0.375 | Passed (L/679) | -- | 1.0 D + 1.0 S (All Spans) |
| Total Load Defl. (in) | 0.267 @ 4' 1" | 0.500 | Passed (L/337) | -- | 1.0 D + 1.0 S (All Spans) |

Member Length : 8'
System : Roof
Member Type : Drop Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD
Member Pitch : 0.25/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 7' 6".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------|----------|-------------|
| | Total | Available | Required | Dead | Snow | Factored | |
| 1 - Stud wall - HF | 5.50" | 5.50" | 2.40" | 1711 | 1684 | 3396 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 2.30" | 1641 | 1616 | 3257 | Blocking |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 8' o/c | |
| Bottom Edge (Lu) | 8' o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Snow (1.15) | Comments |
|-----------------------|-----------------|-----------------|-------------|-------------|--------------|
| 0 - Self Weight (PLF) | 0 to 8' | N/A | 6.4 | -- | |
| 1 - Uniform (PSF) | 0 to 8' (Front) | 16' 6" | 25.0 | 25.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



Roof Framing, Grid G 9' Deck Roof Beam
1 piece(s) 3 1/2" x 9" 24F-V4 DF Glulam

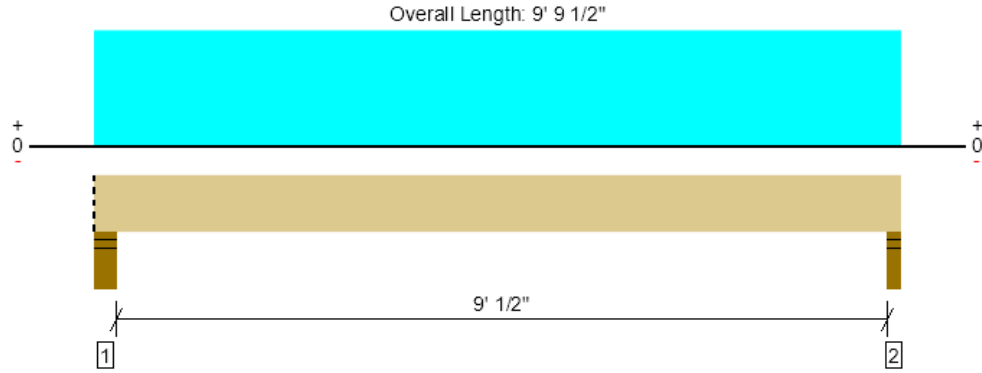

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|--------------------|--------------|----------------|------|-----------------------------|
| Member Reaction (lbs) | 4414 @ 9' 7 1/2" | 4961 (3.50") | Passed (89%) | -- | 1.0 D + 1.0 S (All Spans) |
| Shear (lbs) | 3459 @ 1' 2 1/2" | 6400 | Passed (54%) | 1.15 | 1.0 D + 1.0 S (All Spans) |
| Pos Moment (Ft-lbs) | 9899 @ 4' 11 3/4" | 10868 | Passed (91%) | 1.15 | 1.0 D + 1.0 S (All Spans) |
| Live Load Defl. (in) | 0.199 @ 4' 11 3/4" | 0.465 | Passed (L/559) | -- | 1.0 D + 1.0 S (All Spans) |
| Total Load Defl. (in) | 0.402 @ 4' 11 3/4" | 0.620 | Passed (L/277) | -- | 1.0 D + 1.0 S (All Spans) |

Member Length : 9' 9 1/2"
System : Roof
Member Type : Drop Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD
Member Pitch : 0.25/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume/size factor of 1.00 that was calculated using length L = 9' 3 1/2".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|--------------------|----------------|-----------|----------|-------------------------|------|----------|-------------|
| | Total | Available | Required | Dead | Snow | Factored | |
| 1 - Stud wall - HF | 5.50" | 5.50" | 3.22" | 2303 | 2264 | 4567 | Blocking |
| 2 - Stud wall - HF | 3.50" | 3.50" | 3.11" | 2226 | 2188 | 4414 | None |

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 9' 10" o/c | |
| Bottom Edge (Lu) | 9' 10" o/c | |

- Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location (Side) | Tributary Width | Dead (0.90) | Snow (1.15) | Comments |
|-----------------------|------------------------|-----------------|-------------|-------------|--------------|
| 0 - Self Weight (PLF) | 0 to 9' 9 1/2" | N/A | 7.7 | -- | |
| 1 - Uniform (PSF) | 0 to 9' 9 1/2" (Front) | 18' 2 1/4" | 25.0 | 25.0 | Default Load |

- Side loads are assumed to not induce cross-grain tension.

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



Roof Framing, 6' Window Header
1 piece(s) 4 x 10 DF No.2

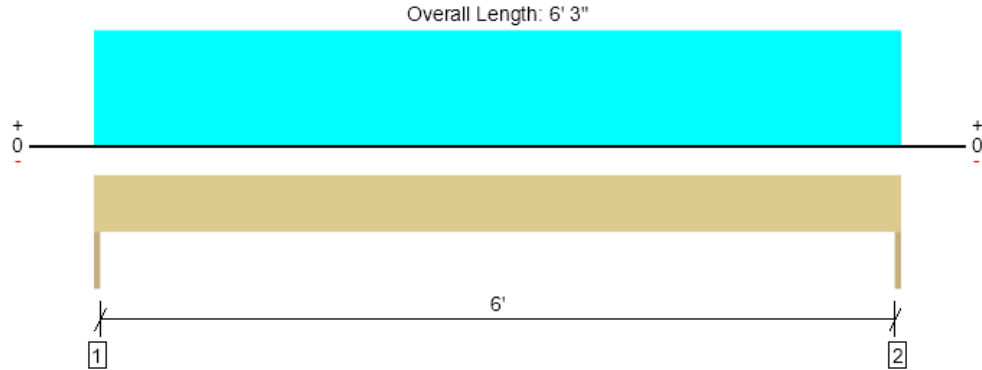

Drawing is Conceptual. All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal (typ.).

| Design Results | Actual @ Location | Allowed | Result | LDF | Load: Combination (Pattern) |
|-----------------------|-------------------|--------------|-----------------|------|-----------------------------|
| Member Reaction (lbs) | 2956 @ 0 | 3281 (1.50") | Passed (90%) | -- | 1.0 D + 1.0 S (All Spans) |
| Shear (lbs) | 2108 @ 10 3/4" | 4468 | Passed (47%) | 1.15 | 1.0 D + 1.0 S (All Spans) |
| Moment (Ft-lbs) | 4618 @ 3' 1 1/2" | 5166 | Passed (89%) | 1.15 | 1.0 D + 1.0 S (All Spans) |
| Live Load Defl. (in) | 0.044 @ 3' 1 1/2" | 0.208 | Passed (L/999+) | -- | 1.0 D + 1.0 S (All Spans) |
| Total Load Defl. (in) | 0.088 @ 3' 1 1/2" | 0.313 | Passed (L/853) | -- | 1.0 D + 1.0 S (All Spans) |

Member Length : 6' 3"
System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

| Supports | Bearing Length | | | Loads to Supports (lbs) | | | Accessories |
|------------------|----------------|-----------|----------|-------------------------|------|----------|-------------|
| | Total | Available | Required | Dead | Snow | Factored | |
| 1 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1491 | 1465 | 2956 | None |
| 2 - Trimmer - HF | 1.50" | 1.50" | 1.50" | 1491 | 1465 | 2956 | None |

| Lateral Bracing | Bracing Intervals | Comments |
|------------------|-------------------|----------|
| Top Edge (Lu) | 6' 3" o/c | |
| Bottom Edge (Lu) | 6' 3" o/c | |

•Maximum allowable bracing intervals based on applied load.

| Vertical Loads | Location | Tributary Width | Dead (0.90) | Snow (1.15) | Comments |
|-----------------------|------------|-----------------|-------------|-------------|--------------|
| 0 - Self Weight (PLF) | 0 to 6' 3" | N/A | 8.2 | -- | |
| 1 - Uniform (PSF) | 0 to 6' 3" | 18' 9" | 25.0 | 25.0 | Default Load |

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

| ForteWEB Software Operator | Job Notes |
|-------------------------------------------------------------------------------------|-----------|
| Chon Pieruccioni Pieruccioni Engineering (206) 949-7866 cpieru@hotmail.com | |



8/23/2024 7:44:30 PM UTC
ForteWEB v3.8, Engine: V8.4.1.24, Data: V8.1.6.3
File Name: East Town Crossing Building H



Pieruccioni Engineering and Construction, L

Project:

Page # _____

Engineer:

8/23/2024

Descrip: Grid 4G Footing

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

GEOMETRY

| | | | |
|------------------------------|-----------|----|----|
| Footing Length (X-dir) | 3.50 | ft | |
| Footing Width (Z-dir) | 3.50 | ft | |
| Footing Thickness | 8.0 | in | OK |
| Soil Cover | 0.00 | ft | |
| Column Length (X-dir) | 6.0 | in | |
| Column Width (Z-dir) | 6.0 | in | |
| Offset (X-dir) | 0.00 | in | OK |
| Offset (Z-dir) | 0.00 | in | OK |
| Base Plate (L x W) | 6.0 x 6.0 | in | |

SOIL PRESSURES (D+L)

| | | | |
|--------------------------------------|-------|-----|----|
| Gross Allow. Soil Pressure | 2.0 | ksf | |
| Soil Pressure at Corner 1 | 1.5 | ksf | |
| Soil Pressure at Corner 2 | 1.5 | ksf | |
| Soil Pressure at Corner 3 | 1.5 | ksf | |
| Soil Pressure at Corner 4 | 1.5 | ksf | |
| Bearing Pressure Ratio | 0.76 | | OK |
| Ftg. Area in Contact with Soil | 100.0 | % | |
| X-eccentricity / Ftg. Length | 0.00 | | OK |
| Z-eccentricity / Ftg. Width | 0.00 | | OK |

APPLIED LOADS

| | Dead | Live | RLive | Snow | Wind | Seismic | |
|----------------------|------|------|-------|------|------|---------|------|
| Axial Force P | 5.2 | 12.8 | 0.0 | 0.0 | 0.0 | 0.0 | kip |
| Moment about X Mx .. | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | k-ft |
| Moment about Z Mz .. | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | k-ft |
| Shear Force Vx | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | kip |
| Shear Force Vz | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | kip |

OVERTURNING CALCULATIONS (Comb: 0.6D+0.6W)

- Overturning about X-X

- Moment Mx = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 k-ft

- Shear Force Vz = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 kip

Arm = 0.00 + 8.0 / 12 = 0.67 ft

Moment = 0.0 * 0.67 = 0.0 k-ft

- Passive Force = 0.0 kip

Arm = 0.27 ft

Moment = 0.0 k-ft

- Overturning moment X-X = 0.0 + 0.0 = 0.0 k-ft

- Resisting about X-X

- Footing weight = $0.6 * W * L * Thick * Density = 0.6 * 3.50 * 3.50 * 8.0 / 12 * 0.15 = 0.7$ kip

Arm = $W / 2 = 3.50 / 2 = 1.75$ ft

Moment = $0.7 * 1.75 = 1.3$ k-ft

- Pedestal weight = $0.6 * W * L * H * Density = 0.6 * 6.0 / 12 * 6.0 / 12 * 0.0 * 0.15 = 0.0$ kip

Arm = $W / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75$ ft

Moment = $0.0 * 1.75 = 0.0$ k-ft

- Soil cover = $0.6 * W * L * SC * Density = 0.6 * (3.50 * 3.50 - 6.0 / 12 * 6.0 / 12) * 0.0 * 110 = 0.0$ kip

Arm = $W / 2 = 3.50 / 2 = 1.75$ ft

Moment = $0.0 * 1.75 = 0.0$ k-ft

- Buoyancy = $0.6 * W * L * \gamma * (SC + Thick - WT) = 0.6 * 3.50 * 3.50 * 62 * (0.67) = -0.3$ kip

Arm = $W / 2 = 3.50 / 2 = 1.75$ ft

Moment = $0.3 * 1.75 = -0.5$ k-ft


- Axial force P = $0.6 * 5.2 + 0.6 * 0.0 = 3.1$ kip

Arm = $W / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75$ ft

Moment = $3.1 * 1.75 = 5.5$ k-ft

- Resisting moment X-X = $1.3 + 0.0 + 0.0 + 5.5 + -0.5 = 6.2$ k-ft

- Overturning safety factor X-X = $\frac{Resisting\ moment}{Overturning\ moment} = \frac{6.2}{0.0} = 62.11 > 1.50$ OK



Pieruccioni Engineering and Construction, L

Project:

Page # ____

Engineer:

8/23/2024

Descrip: Grid 4G Footing

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

- Overturning about Z-Z

$$\text{- Moment } M_z = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 \text{ k-ft}$$

$$\text{- Shear Force } V_x = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 \text{ kip}$$

$$\text{Arm} = 0.00 + 8.0 / 12 = 0.67 \text{ ft}$$

$$\text{Moment} = 0.0 * 0.67 = 0.0 \text{ k-ft}$$

$$\text{- Passive Force} = 0.0 \text{ kip}$$

$$\text{Arm} = 0.27 \text{ ft}$$

$$\text{Moment} = 0.0 \text{ k-ft}$$

$$\text{- Overturning moment Z-Z} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

- Resisting about Z-Z

$$\text{- Footing weight} = 0.6 * W * L * Thick * Density = 0.6 * 3.50 * 3.50 * 8.0 / 12 * 0.15 = 0.7 \text{ kip}$$

$$\text{Arm} = L / 2 = 3.50 / 2 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.7 * 1.75 = 1.3 \text{ k-ft}$$

$$\text{- Pedestal weight} = 0.6 * W * L * H * Density = 0.6 * 6.0 / 12 * 6.0 / 12 * 0.0 * 0.15 = 0.0 \text{ kip}$$

$$\text{Arm} = L / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.0 * 1.75 = 0.0 \text{ k-ft}$$

$$\text{- Soil cover} = 0.6 * W * L * SC * Density = 0.6 * (3.50 * 3.50 - 6.0 / 12 * 6.0 / 12) * 0.0 * 110 = 0.0 \text{ kip}$$

$$\text{Arm} = L / 2 = 3.50 / 2 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.0 * 1.75 = 0.0 \text{ k-ft}$$

$$\text{- Buoyancy} = 0.6 * W * L * \gamma * (SC + Thick - WT) = 0.6 * 3.50 * 3.50 * 62 * (0.67) = -0.3 \text{ kip}$$

$$\text{Arm} = L / 2 = 3.50 / 2 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.3 * 1.75 = -0.5 \text{ k-ft}$$

$$\text{- Axial force } P = 0.6 * 5.2 + 0.6 * 0.0 = 3.1 \text{ kip}$$

$$\text{Arm} = L / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75 \text{ ft}$$

$$\text{Moment} = 3.1 * 1.75 = 5.5 \text{ k-ft}$$

$$\text{- Resisting moment Z-Z} = 1.3 + 0.0 + 0.0 + 5.5 - 0.5 = 6.2 \text{ k-ft}$$

$$\text{- Overturning safety factor Z-Z} = \frac{\text{Resisting moment}}{\text{Overturning moment}} = \frac{6.2}{0.0} = 62.11 > 1.50 \text{ OK}$$

SOIL BEARING PRESSURES (Comb: D+L)

$$\text{Overturning moment X-X} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

$$\text{Resisting moment X-X} = 2.1 + 0.0 + 0.0 + -0.9 + 31.5 = 32.8 \text{ k-ft}$$

$$\text{Overturning moment Z-Z} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

$$\text{Resisting moment Z-Z} = 2.1 + 0.0 + 0.0 + -0.9 + 31.5 = 32.8 \text{ k-ft}$$

$$\text{Resisting force} = \text{Footing} + \text{Pedestal} + \text{Soil} - \text{Buoyancy} + P = 1.2 + 0.0 + 0.0 - 0.5 + 18.0 = 18.7 \text{ kip}$$

X-coordinate of resultant from maximum bearing corner:

$$X_p = \frac{Z\text{-Resisting moment} - Z\text{-Overturning moment}}{\text{Resisting force}} = \frac{32.8 - 0.0}{18.7} = 1.75 \text{ ft}$$

Z-coordinate of resultant from maximum bearing corner:

$$Z_p = \frac{X\text{-Resisting moment} - X\text{-Overturning moment}}{\text{Resisting force}} = \frac{32.8 - 0.0}{18.7} = 1.75 \text{ ft}$$

$$X\text{-ecc} = \text{Length} / 2 - X_p = 3.50 / 2 - 1.75 = 0.00 \text{ ft}$$

$$Z\text{-ecc} = \text{Width} / 2 - Z_p = 3.50 / 2 - 1.75 = 0.00 \text{ ft}$$

$$\text{Area} = \text{Width} * \text{Length} = 3.50 * 3.50 = 12.3 \text{ ft}^2$$

$$S_x = \text{Length} * \text{Width}^2 / 6 = 3.50 * 3.50^2 / 6 = 7.1 \text{ ft}^3$$

$$S_z = \text{Width} * \text{Length}^2 / 6 = 3.50 * 3.50^2 / 6 = 7.1 \text{ ft}^3$$



- Footing is in full bearing. Soil pressures are as follows:

$$P1 = P * (1/A + Z\text{-ecc} / S_x + X\text{-ecc} / S_z) = 18.7 * (1 / 12.3 + 0.00 / 7.1 + 0.00 / 7.1) = 1.53 \text{ ksf}$$

$$P2 = P * (1/A - Z\text{-ecc} / S_x + X\text{-ecc} / S_z) = 18.7 * (1 / 12.3 - 0.00 / 7.1 + 0.00 / 7.1) = 1.53 \text{ ksf}$$

$$P3 = P * (1/A - Z\text{-ecc} / S_x - X\text{-ecc} / S_z) = 18.7 * (1 / 12.3 - 0.00 / 7.1 - 0.00 / 7.1) = 1.53 \text{ ksf}$$

$$P4 = P * (1/A + Z\text{-ecc} / S_x - X\text{-ecc} / S_z) = 18.7 * (1 / 12.3 + 0.00 / 7.1 - 0.00 / 7.1) = 1.53 \text{ ksf}$$

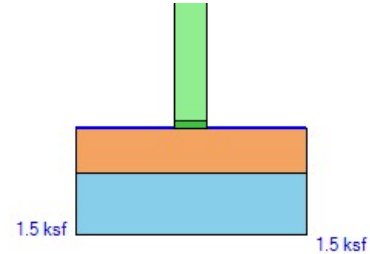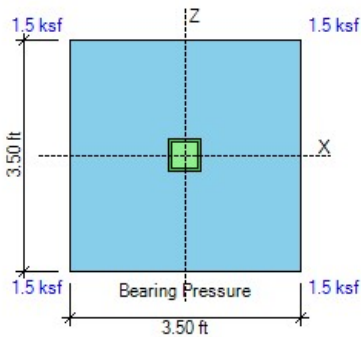

SLIDING CALCULATIONS (Comb: 0.6D+0.6W)

Internal friction angle = 28.0 deg

Passive coefficient $k_p = 4.33$ (per Coulomb)

Pressure at mid-depth = $k_p \cdot \text{Density} \cdot (\text{Cover} + \text{Thick} / 2) = 4.33 \cdot 110 \cdot (0.00 + 8.0 / 12 / 2) = 0.16$ ksf

X-Passive force = $\text{Pressure} \cdot \text{Thick} \cdot \text{Width} = 0.16 \cdot 8.0 / 12 \cdot 3.50 = 0.4$ kip

Z-Passive force = $\text{Pressure} \cdot \text{Thick} \cdot \text{Length} = 0.16 \cdot 8.0 / 12 \cdot 3.50 = 0.4$ kip

Friction force = $\text{Resisting force} \cdot \text{Friction coeff.} = \text{Max}(0, 3.5 \cdot 0.35) = 1.2$ kip

Use 100% of Passive + 100% of Friction for sliding resistance

$$\text{- Sliding safety factor X-X} = \frac{\text{X-Passive force} + \text{Friction}}{\text{X-Horizontal load}} = \frac{1.00 \cdot 0.4 + 1.00 \cdot 1.2}{0.0} = 16.12 > 1.50 \text{ OK}$$

$$\text{- Sliding safety factor Z-Z} = \frac{\text{Z-Passive force} + \text{Friction}}{\text{Z-Horizontal load}} = \frac{1.00 \cdot 0.4 + 1.00 \cdot 1.2}{0.0} = 16.12 > 1.50 \text{ OK}$$

UPLIFT CALCULATIONS (Comb: 0.6D+0.6W)

$$\text{- Uplift safety factor} = \frac{\text{Pedestal} + \text{Footing} + \text{Cover} - \text{Buoyancy}}{\text{Uplift load}} = \frac{0.0 + 0.7 + 0.0 - 0.3}{0.0} = 99.99 > 1.00 \text{ OK}$$

ONE-WAY SHEAR CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

Concrete $f'_c = 2.5$ ksi

Steel $f_y = 40.0$ ksi

Soil density = 110 pcf

d Top X-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} / 2 = 8.0 - 2.0 - 0.8 / 2 = 5.6$ in

d Top Z-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} - \text{Z-diameter} / 2 = 8.0 - 2.0 - 0.8 - 0.8 / 2 = 4.9$ in

d Bot X-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} / 2 = 8.0 - 3.0 - 0.5 / 2 = 4.8$ in

d Bot Z-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} - \text{Z-diameter} / 2 = 8.0 - 3.0 - 0.5 - 0.5 / 2 = 4.3$ in

$\phi V_{cx} = 2 \cdot \phi \cdot \sqrt{f'_c} \cdot \text{Width} \cdot d / 1000 = 2 \cdot 0.75 \cdot \sqrt{(2500)} \cdot 3.5 \cdot 12 \cdot 4.8 / 1000 = 15.0$ kip

ACI Eq. (22.5.5.1)

$\phi V_{cz} = 2 \cdot \phi \cdot \sqrt{f'_c} \cdot \text{Length} \cdot d / 1000 = 2 \cdot 0.75 \cdot \sqrt{(2500)} \cdot 3.5 \cdot 12 \cdot 4.3 / 1000 = 13.4$ kip



- Shear forces calculated as the volume of the bearing pressures under the effective areas:

One-way shear V_{ux} (- Side) = 8.6 kip < 15.0 kip OK

One-way shear V_{ux} (+ Side) = 8.6 kip < 15.0 kip OK

One-way shear V_{uz} (- Side) = 8.6 kip < 13.4 kip OK

One-way shear V_{uz} (+ Side) = 8.6 kip < 13.4 kip OK

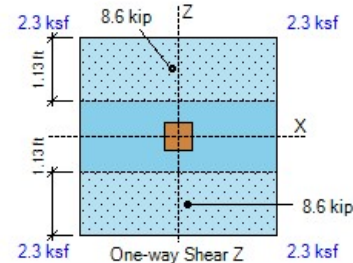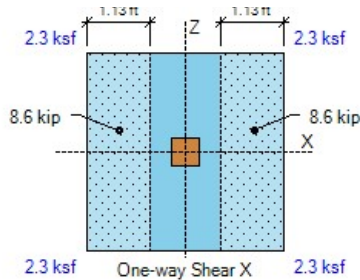

FLEXURE CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

$$\text{Plain } \phi M_{nx} = 5 * \phi * \sqrt{f_c} * L * \text{Thick}^2 / 6 = 5 * 0.60 * \sqrt{(2500)} * 3.50 * 8.0^2 / 6 / 1000 = 1.5 \text{ k-ft}$$

ACI Eq. (14.5.2.1a)

$$\text{Plain } \phi M_{nz} = 5 * \phi * \sqrt{f_c} * W * \text{Thick}^2 / 6 = 5 * 0.60 * \sqrt{(2500)} * 3.50 * 8.0^2 / 6 / 1000 = 1.5 \text{ k-ft}$$

- Top Bars

No Top Reinforcement Provided at the Footing

Use Plain Concrete Flexural Strength at Top

- Top moments calculated as the overburden minus the bearing pressures times the lever arm:

$$\text{Top moment -Mux (- Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

$$\text{Top moment -Mux (+ Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

$$\text{Top moment -Muz (- Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

$$\text{Top moment -Muz (+ Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

- Bottom Bars

$$\text{Use 5 \#4 Z-Bars } \rho = A_s / b d = 1.0 / (3.50 * 12 * 4.3) = 0.0056$$

$$q = 0.0056 * 40 / 2.5 = 0.090$$

$$\text{Use 5 \#4 X-Bars } \rho = A_s / b d = 1.0 / (3.50 * 12 * 4.8) = 0.0050$$

$$q = 0.0050 * 40 / 2.5 = 0.080$$

$$\beta = L / W = 3.50 / 3.50 = 1.00 \quad \gamma_s = 2 * \beta / (\beta + 1) = 2 * 1.00 / (1.00 + 1) = 1.00$$

ACI 13.3.3.3

$$\text{Bending strength } \phi M_n = \phi * b * d^2 * f_c * q * (1 - 0.59 * q)$$

ACI 22.2.2

$$\phi M_{nx} = 0.90 * 3.50 * 12 * 4.3^2 * 2.5 * 0.090 * (1 - 0.59 * 0.090) = 12.1 \text{ k-ft}$$

$$\phi M_{nz} = 0.90 * 3.50 * 12 * 4.8^2 * 2.5 * 0.080 / 1.00 * (1 - 0.59 * 0.080 / 1.00) = 13.6 \text{ k-ft}$$

- Bottom moments calculated as the bearing minus the overburden pressures times the lever arm:

$$\text{Bottom moment Mux (- Side)} = 8.6 \text{ k-ft} < 12.1 \text{ k-ft OK} \quad \text{ratio} = 0.71$$

$$\text{Bottom moment Mux (+ Side)} = 8.6 \text{ k-ft} < 12.1 \text{ k-ft OK} \quad \text{ratio} = 0.71$$

$$\text{Bottom moment Muz (- Side)} = 8.6 \text{ k-ft} < 13.6 \text{ k-ft OK} \quad \text{ratio} = 0.63$$

$$\text{Bottom moment Muz (+ Side)} = 8.6 \text{ k-ft} < 13.6 \text{ k-ft OK} \quad \text{ratio} = 0.63$$

$$\text{X-As min} = 0.0018 * \text{Width} * \text{Thick} = 0.0018 * 3.50 * 12 * 8.0 = 0.6 \text{ in}^2 < 1.0 \text{ in}^2 \text{ OK}$$

ACI 8.6.1.1

$$\text{Z-As min} = 0.0018 * \text{Length} * \text{Thick} = 0.0018 * 3.50 * 12 * 8.0 = 0.6 \text{ in}^2 < 1.0 \text{ in}^2 \text{ OK}$$

ACI 8.6.1.1

$$\text{X-As max for 0.005 tension strain} = 3.20 \text{ in}^2 > 1.00 \text{ in}^2 \text{ OK}$$

ACI 21.2.2

$$\text{Z-As max for 0.005 tension strain} = 3.20 \text{ in}^2 > 1.00 \text{ in}^2 \text{ OK}$$

ACI 21.2.2

$$\text{X-Cover factor} = \text{Min} (2.5, (\text{Cover} + db / 2, \text{Spacing} / 2) / db) = \text{Min} (2.5, (3.0 + 0.50 / 2, 9.0 / 2) / 0.50) = 2.5$$

$$\text{Straight } X\text{-Ld} = \text{Max} (12.0, 3 / 40 * f_y / (f_c)^{1/2} * \text{Grade} * \text{Size} * \text{Casting} / \text{Cover} * db * \text{ratio})$$

ACI Eq. (25.4.2.3a)

$$X\text{-Ld} = \text{Max} (12.0, 3 / 40 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.8 * 1.0 / 2.5 * 0.50 * 0.63) = 12.0 \text{ in}$$


$$\text{Hooked } X\text{-Ldh} = \text{Max} (8 db, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * db * \text{ratio}) =$$

ACI 25.4.3

$$X\text{-Ldh} = \text{Max} (8 db, 6, 0.02 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.50 * 0.63) = 6.0 \text{ in}$$

$$\text{-X Ld provided} = (\text{Length} - \text{Col}) / 2 + \text{Offset} - \text{Cover} = 3.50 * 12 / 2 + 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK}$$

$$\text{+X Ld provided} = (\text{Length} - \text{Col}) / 2 - \text{Offset} - \text{Cover} = 3.50 * 12 / 2 - 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK} \quad 4 \text{ of } 7$$



Pieruccioni Engineering and Construction, L

Project:

Engineer:

Descrip: Grid 4G Footing

Page # ____

8/23/2024

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

$$Z\text{-Cover factor} = \text{Min} (2.5, (\text{Cover} + db / 2, \text{Spacing} / 2) / db) = \text{Min} (2.5, (3.0 + 0.50 / 2, 9.0 / 2) / 0.50) = 2.5$$

$$\text{Straight } Z\text{-Ld} = \text{Max} (12.0, 3 / 40 * f_y / (f_c)^{1/2} * \text{Grade} * \text{Size} * \text{Casting} / \text{Cover} * db * \text{ratio})$$

ACI Eq. (25.4.2.3a)

$$Z\text{-Ld} = \text{Max} (12.0, 3 / 40 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.8 * 1.0 / 2.5 * 0.50 * 0.63) = 12.0 \text{ in}$$

$$\text{Hooked } Z\text{-Ldh} = \text{Max} (8 \text{ db}, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * db * \text{ratio}) =$$

ACI 25.4.3

$$Z\text{-Ldh} = \text{Max} (8 \text{ db}, 6, 0.02 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.50 * 0.71) = 6.0 \text{ in}$$



$$-Z \text{ Ld provided} = (\text{Width} - \text{Col}) / 2 + \text{Offset} - \text{Cover} = 3.50 * 12 / 2 + 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK}$$

$$+Z \text{ Ld provided} = (\text{Width} - \text{Col}) / 2 - \text{Offset} - \text{Cover} = 3.50 * 12 / 2 - 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK}$$

$$X\text{-bar spacing} = 9.0 \text{ in} < \text{Min} (3 * t, 18.0) = 18.0 \text{ in OK}$$

ACI 7.7.2.3

$$Z\text{-bar spacing} = 9.0 \text{ in} < \text{Min} (3 * t, 18.0) = 18.0 \text{ in OK}$$

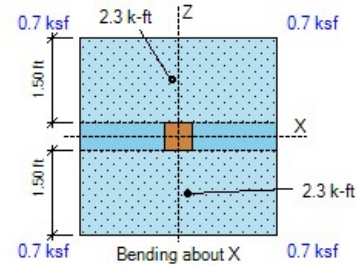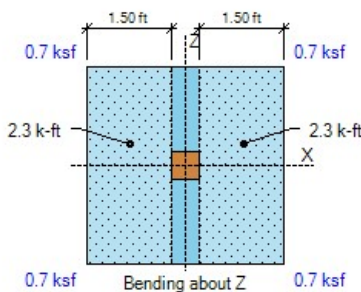

LOAD TRANSFER CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

$$\text{Area } A1 = \text{col } L * \text{col } W = 6.0 * 6.0 = 36.0 \text{ in}^2$$

$$Sx = \text{col } W * \text{col } L^2 / 6 = 6.0 * 6.0^2 / 6 = 36.0 \text{ in}^3$$

$$Sz = \text{col } L * \text{col } W^2 / 6 = 6.0 * 6.0^2 / 6 = 36.0 \text{ in}^3$$

$$\text{Bearing } Pbu = P / A1 + Mz / Sx + Mx / Sz = 26.7 / 36.0 + 0.0 * 12 / 36.0 + 0.0 * 12 / 36.0 = 0.7 \text{ ksi}$$

$$\text{Min edge} = \text{Min} (L / 2 - X\text{-offset} - \text{col } L / 2, W / 2 - Z\text{-offset} - \text{col } W / 2)$$

$$\text{Min edge} = \text{Min} (3.50 * 12 / 2 - 0.0 - 6.0 / 2, 3.50 * 12 / 2 - 0.0 - 6.0 / 2) = 18.0 \text{ in}$$

$$\text{Area } A2 = \text{Min} [L * W, (\text{col } L + 2 * \text{Min edge}) * (\text{col } W + 2 * \text{Min edge})]$$

ACI R22.8.3.2

$$A2 = \text{Min} [3.50 * 12 * 3.5 * 12, (6.0 + 2 * 18.0) * (6.0 + 2 * 18.0)] = 1764.0 \text{ in}^2$$

$$\text{Footing } \phi Pnc = \phi * 0.85 * f_c * \text{Min} [2, \sqrt{A2 / A1}] = 0.65 * 0.85 * 2.5 * \text{Min} [2, \sqrt{(1764.0 / 36.0)}] = 2.8 \text{ ksi}$$

$$\text{Footing } \phi Pns = \phi * As * Fy / A1 = 0.0 \text{ ksi}$$

ACI 22.8.3.2

$$\text{Footing bearing } \phi Pn = \phi Pnc + \phi Pns = 2.8 + 0.0 = 2.8 \text{ ksi} > 0.7 \text{ psi OK}$$

Hooked $L_{dh} = \text{Max} (8 \text{ db}, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * \text{db} * \text{ratio})$

ACI 25.4.3

$$L_{dh} = \text{Max} (8 \text{ db}, 6, 0.02 * 60.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.75 * 0.13) = 6.0 \text{ in}$$

Ld provided = Dowel length = $3.00 * 12 = 36.0 \text{ in} > 23.1 \text{ in OK}$

Ldh provided = Footing thickness - Cover = $8.00 - 3.0 = 5.0 \text{ in} < 6.0 \text{ in NG}$

PUNCHING SHEAR CALCULATIONS (Comb: 1.2D+1.6L+0.5Lr)

$$\text{X-Edge} = d/2 = 4.5 / 2 = 2.3 \text{ in} \quad \text{asx} = 20$$

$$\text{Z-Edge} = d/2 = 4.5 / 2 = 2.3 \text{ in} \quad \text{asz} = 20$$

$$\text{as} = \text{asx} + \text{asz} = 20 + 20 = 40 \quad \text{Col type} = \text{Interior} \quad \beta = L / W = 6.0 / 6.0 = 1.00$$

ACI 22.6.5.2

$$\text{Perimeter } b_o = \text{asx} / 10 * (L + d/2 + \text{X-Edge}) + \text{asz} / 10 * (W + d/2 + \text{Z-Edge})$$

ACI 22.6.4.2

$$b_o = 20 / 10 * (6.0 + 4.5 / 2 + 2.3) + 20 / 10 * (6.0 + 4.5 / 2 + 2.3) = 42.0 \text{ in}$$

$$\text{Area } A_{bo} = (L + d/2 + \text{X-Edge}) * (W + d/2 + \text{Z-Edge}) = (6.0 + 4.5 / 2 + 2.3) * (6.0 + 4.5 / 2 + 2.3) = 110.3 \text{ in}^2$$

$$\phi V_c = \phi * \text{Min} (2 + 4 / \beta, \text{as} * d / b_o + 2, 4) * \sqrt{f_c}$$

ACI 22.6.5.2

$$\phi V_c = 0.75 * \text{Min} (2 + 4 / 1.00, 40 * 4.5 / 42.0 + 2, 4) * \sqrt{2500} = 150.0 \text{ psi}$$

Punching force $F = P + \text{Overburden} * A_{bo} - \text{Bearing}$

$$F = 26.7 + 0.07 * 110.3 / 144 - 1.7 = 25.1 \text{ kip}$$

$$b1 = L + d/2 + \text{X-Edge} = 6.0 + 4.5 / 2 + 2.3 = 10.5 \text{ in} \quad b2 = W + d/2 + \text{Z-Edge} = 6.0 + 4.5 / 2 + 2.3 = 10.5 \text{ in}$$

$$\gamma_{vx} \text{ factor} = 1 - \frac{1}{1 + (2/3) \sqrt{b2/b1}} = 1 - \frac{1}{1 + (2/3) \sqrt{10.5/10.5}} = 0.40$$

ACI Eq. (8.4.4.2.2)

$$\gamma_{vz} \text{ factor} = 1 - \frac{1}{1 + (2/3) \sqrt{b1/b2}} = 1 - \frac{1}{1 + (2/3) \sqrt{10.5/10.5}} = 0.40$$

ACI Eq. (8.4.2.3.2)

$$X2z = b1/2 = 10.5/2 = 5.3 \text{ in} \quad X2x = b2/2 = 10.5/2 = 5.3 \text{ in}$$

$$J_{cz} = b1 * d^3 / 6 + b1^3 * d / 6 + b1^2 * b2 * d / 2$$

ACI R8.4.4.2.3

$$J_{cz} = 10.5 * 4.5^3 / 6 + 10.5^3 * 4.5 / 6 + 10.5^2 * 10.5 * 4.5 / 2 = 3632 \text{ in}^4$$

$$J_{cx} = b2 * d^3 / 6 + b2^3 * d / 6 + b2^2 * b1 * d / 2$$

ACI R8.4.4.2.3


$$J_{cx} = 10.5 * 4.5^3 / 6 + 10.5^3 * 4.5 / 6 + 10.5^2 * 10.5 * 4.5 / 2 = 3632 \text{ in}^4$$


$$\text{Stress due to } P = F / (b_o * d) * 1000 = 25.1 / (42.0 * 4.5) * 1000 = 132.5 \text{ psi}$$

$$\text{Stress due to } M_x = \gamma_{vx} * X\text{-OTM} * X2x / J_{cx} = 0.40 * 0.0 * 12 * 5.3 / 3632 * 1000 = 0.0 \text{ psi}$$

$$\text{Stress due to } M_z = \gamma_{vz} * Z\text{-OTM} * X2z / J_{cz} = 0.40 * 0.0 * 12 * 5.3 / 3632 * 1000 = 0.0 \text{ psi}$$

$$\text{Punching stress} = P\text{-stress} + M_x\text{-stress} + M_z\text{-stress} = 132.5 + 0.0 + 0.0 = 132.5 \text{ psi} < 150.0 \text{ psi OK}$$

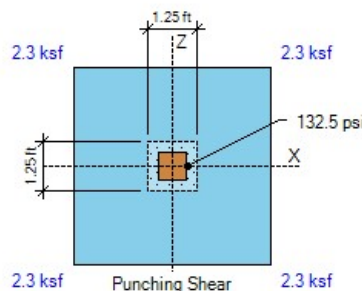



Pieruccioni Engineering and Construction, L

Project:

Engineer:

Descrip: Grid 4G Footing

Page # ____

8/23/2024

ASDIP Foundation 5.3.0.0


SPREAD FOOTING DESIGN


www.asdipsoft.com

DESIGN CODES

Concrete Design ACI 318-14

Load Combinations ASCE 7-10/16

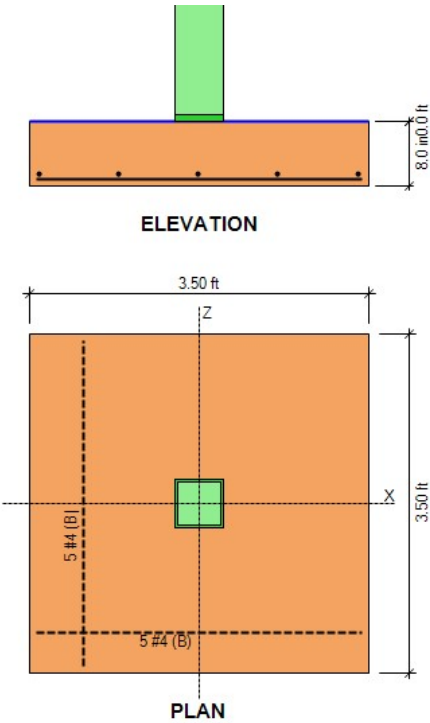



Pieruccioni Engineering and Construction, L

Project:

Page # _____

Engineer:

8/23/2024

Descrip: Grid 5D Footing

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

GEOMETRY

| | | | |
|------------------------------|-----------|----|----|
| Footing Length (X-dir) | 3.50 | ft | |
| Footing Width (Z-dir) | 3.50 | ft | |
| Footing Thickness | 8.0 | in | OK |
| Soil Cover | 0.00 | ft | |
| Column Length (X-dir) | 6.0 | in | |
| Column Width (Z-dir) | 6.0 | in | |
| Offset (X-dir) | 0.00 | in | OK |
| Offset (Z-dir) | 0.00 | in | OK |
| Base Plate (L x W) | 6.0 x 6.0 | in | |

SOIL PRESSURES (D+L)

| | | | |
|--------------------------------------|-------|-----|----|
| Gross Allow. Soil Pressure | 2.0 | ksf | |
| Soil Pressure at Corner 1 | 1.8 | ksf | |
| Soil Pressure at Corner 2 | 1.8 | ksf | |
| Soil Pressure at Corner 3 | 1.8 | ksf | |
| Soil Pressure at Corner 4 | 1.8 | ksf | |
| Bearing Pressure Ratio | 0.90 | | OK |
| Ftg. Area in Contact with Soil | 100.0 | % | |
| X-eccentricity / Ftg. Length | 0.00 | | OK |
| Z-eccentricity / Ftg. Width | 0.00 | | OK |

APPLIED LOADS

| | Dead | Live | RLive | Snow | Wind | Seismic | |
|----------------------|------|------|-------|------|------|---------|------|
| Axial Force P | 6.0 | 15.3 | 0.0 | 0.0 | 0.0 | 0.0 | kip |
| Moment about X Mx .. | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | k-ft |
| Moment about Z Mz .. | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | k-ft |
| Shear Force Vx | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | kip |
| Shear Force Vz | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | kip |

OVERTURNING CALCULATIONS (Comb: 0.6D+0.6W)

- Overturning about X-X

- Moment Mx = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 k-ft

- Shear Force Vz = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 kip

Arm = 0.00 + 8.0 / 12 = 0.67 ft

Moment = 0.0 * 0.67 = 0.0 k-ft

- Passive Force = 0.0 kip

Arm = 0.27 ft

Moment = 0.0 k-ft

- Overturning moment X-X = 0.0 + 0.0 = 0.0 k-ft

- Resisting about X-X

- Footing weight = $0.6 * W * L * Thick * Density = 0.6 * 3.50 * 3.50 * 8.0 / 12 * 0.15 = 0.7$ kip

Arm = $W / 2 = 3.50 / 2 = 1.75$ ft

Moment = $0.7 * 1.75 = 1.3$ k-ft

- Pedestal weight = $0.6 * W * L * H * Density = 0.6 * 6.0 / 12 * 6.0 / 12 * 0.0 * 0.15 = 0.0$ kip

Arm = $W / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75$ ft

Moment = $0.0 * 1.75 = 0.0$ k-ft

- Soil cover = $0.6 * W * L * SC * Density = 0.6 * (3.50 * 3.50 - 6.0 / 12 * 6.0 / 12) * 0.0 * 110 = 0.0$ kip

Arm = $W / 2 = 3.50 / 2 = 1.75$ ft

Moment = $0.0 * 1.75 = 0.0$ k-ft

- Buoyancy = $0.6 * W * L * \gamma * (SC + Thick - WT) = 0.6 * 3.50 * 3.50 * 62 * (0.67) = -0.3$ kip

Arm = $W / 2 = 3.50 / 2 = 1.75$ ft

Moment = $0.3 * 1.75 = -0.5$ k-ft


- Axial force P = $0.6 * 6.0 + 0.6 * 0.0 = 3.6$ kip

Arm = $W / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75$ ft

Moment = $3.6 * 1.75 = 6.3$ k-ft

- Resisting moment X-X = $1.3 + 0.0 + 0.0 + 6.3 + -0.5 = 7.1$ k-ft

- Overturning safety factor X-X = $\frac{Resisting\ moment}{Overturning\ moment} = \frac{7.1}{0.0} = 70.51 > 1.50$ OK



Pieruccioni Engineering and Construction, L

Project:

Engineer:

Descrip: Grid 5D Footing

Page # ____

8/23/2024

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

- Overturning about Z-Z

$$\text{- Moment } M_z = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 \text{ k-ft}$$

$$\text{- Shear Force } V_x = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 \text{ kip}$$

$$\text{Arm} = 0.00 + 8.0 / 12 = 0.67 \text{ ft}$$

$$\text{Moment} = 0.0 * 0.67 = 0.0 \text{ k-ft}$$

$$\text{- Passive Force} = 0.0 \text{ kip}$$

$$\text{Arm} = 0.27 \text{ ft}$$

$$\text{Moment} = 0.0 \text{ k-ft}$$

$$\text{- Overturning moment Z-Z} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

- Resisting about Z-Z

$$\text{- Footing weight} = 0.6 * W * L * Thick * Density = 0.6 * 3.50 * 3.50 * 8.0 / 12 * 0.15 = 0.7 \text{ kip}$$

$$\text{Arm} = L / 2 = 3.50 / 2 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.7 * 1.75 = 1.3 \text{ k-ft}$$

$$\text{- Pedestal weight} = 0.6 * W * L * H * Density = 0.6 * 6.0 / 12 * 6.0 / 12 * 0.0 * 0.15 = 0.0 \text{ kip}$$

$$\text{Arm} = L / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.0 * 1.75 = 0.0 \text{ k-ft}$$

$$\text{- Soil cover} = 0.6 * W * L * SC * Density = 0.6 * (3.50 * 3.50 - 6.0 / 12 * 6.0 / 12) * 0.0 * 110 = 0.0 \text{ kip}$$

$$\text{Arm} = L / 2 = 3.50 / 2 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.0 * 1.75 = 0.0 \text{ k-ft}$$

$$\text{- Buoyancy} = 0.6 * W * L * \gamma * (SC + Thick - WT) = 0.6 * 3.50 * 3.50 * 62 * (0.67) = -0.3 \text{ kip}$$

$$\text{Arm} = L / 2 = 3.50 / 2 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.3 * 1.75 = -0.5 \text{ k-ft}$$

$$\text{- Axial force } P = 0.6 * 6.0 + 0.6 * 0.0 = 3.6 \text{ kip}$$

$$\text{Arm} = L / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75 \text{ ft}$$

$$\text{Moment} = 3.6 * 1.75 = 6.3 \text{ k-ft}$$

$$\text{- Resisting moment Z-Z} = 1.3 + 0.0 + 0.0 + 6.3 + -0.5 = 7.1 \text{ k-ft}$$

$$\text{- Overturning safety factor Z-Z} = \frac{\text{Resisting moment}}{\text{Overturning moment}} = \frac{7.1}{0.0} = 70.51 > 1.50 \text{ OK}$$

SOIL BEARING PRESSURES (Comb: D+L)

$$\text{Overturning moment X-X} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

$$\text{Resisting moment X-X} = 2.1 + 0.0 + 0.0 + -0.9 + 37.3 = 38.5 \text{ k-ft}$$

$$\text{Overturning moment Z-Z} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

$$\text{Resisting moment Z-Z} = 2.1 + 0.0 + 0.0 + -0.9 + 37.3 = 38.5 \text{ k-ft}$$

$$\text{Resisting force} = \text{Footing} + \text{Pedestal} + \text{Soil} - \text{Buoyancy} + P = 1.2 + 0.0 + 0.0 - 0.5 + 21.3 = 22.0 \text{ kip}$$

X-coordinate of resultant from maximum bearing corner:

$$X_p = \frac{Z\text{-Resisting moment} - Z\text{-Overturning moment}}{\text{Resisting force}} = \frac{38.5 - 0.0}{22.0} = 1.75 \text{ ft}$$

Z-coordinate of resultant from maximum bearing corner:

$$Z_p = \frac{X\text{-Resisting moment} - X\text{-Overturning moment}}{\text{Resisting force}} = \frac{38.5 - 0.0}{22.0} = 1.75 \text{ ft}$$

$$X\text{-ecc} = \text{Length} / 2 - X_p = 3.50 / 2 - 1.75 = 0.00 \text{ ft}$$

$$Z\text{-ecc} = \text{Width} / 2 - Z_p = 3.50 / 2 - 1.75 = 0.00 \text{ ft}$$

$$\text{Area} = \text{Width} * \text{Length} = 3.50 * 3.50 = 12.3 \text{ ft}^2$$

$$S_x = \text{Length} * \text{Width}^2 / 6 = 3.50 * 3.50^2 / 6 = 7.1 \text{ ft}^3$$

$$S_z = \text{Width} * \text{Length}^2 / 6 = 3.50 * 3.50^2 / 6 = 7.1 \text{ ft}^3$$



- Footing is in full bearing. Soil pressures are as follows:

$$P1 = P * (1/A + Z\text{-ecc} / S_x + X\text{-ecc} / S_z) = 22.0 * (1 / 12.3 + 0.00 / 7.1 + 0.00 / 7.1) = 1.80 \text{ ksf}$$

$$P2 = P * (1/A - Z\text{-ecc} / S_x + X\text{-ecc} / S_z) = 22.0 * (1 / 12.3 - 0.00 / 7.1 + 0.00 / 7.1) = 1.80 \text{ ksf}$$

$$P3 = P * (1/A - Z\text{-ecc} / S_x - X\text{-ecc} / S_z) = 22.0 * (1 / 12.3 - 0.00 / 7.1 - 0.00 / 7.1) = 1.80 \text{ ksf}$$

$$P4 = P * (1/A + Z\text{-ecc} / S_x - X\text{-ecc} / S_z) = 22.0 * (1 / 12.3 + 0.00 / 7.1 - 0.00 / 7.1) = 1.80 \text{ ksf}$$

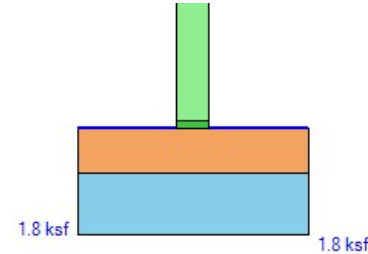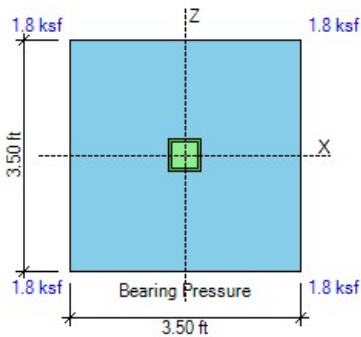

SLIDING CALCULATIONS (Comb: 0.6D+0.6W)

Internal friction angle = 28.0 deg

Passive coefficient $k_p = 4.33$ (per Coulomb)

Pressure at mid-depth = $k_p \cdot \text{Density} \cdot (\text{Cover} + \text{Thick} / 2) = 4.33 \cdot 110 \cdot (0.00 + 8.0 / 12 / 2) = 0.16$ ksf

X-Passive force = $\text{Pressure} \cdot \text{Thick} \cdot \text{Width} = 0.16 \cdot 8.0 / 12 \cdot 3.50 = 0.4$ kip

Z-Passive force = $\text{Pressure} \cdot \text{Thick} \cdot \text{Length} = 0.16 \cdot 8.0 / 12 \cdot 3.50 = 0.4$ kip

Friction force = $\text{Resisting force} \cdot \text{Friction coeff.} = \text{Max}(0, 4.0 \cdot 0.35) = 1.4$ kip

Use 100% of Passive + 100% of Friction for sliding resistance

$$\text{- Sliding safety factor X-X} = \frac{\text{X-Passive force} + \text{Friction}}{\text{X-Horizontal load}} = \frac{1.00 \cdot 0.4 + 1.00 \cdot 1.4}{0.0} = 17.80 > 1.50 \text{ OK}$$

$$\text{- Sliding safety factor Z-Z} = \frac{\text{Z-Passive force} + \text{Friction}}{\text{Z-Horizontal load}} = \frac{1.00 \cdot 0.4 + 1.00 \cdot 1.4}{0.0} = 17.80 > 1.50 \text{ OK}$$

UPLIFT CALCULATIONS (Comb: 0.6D+0.6W)

$$\text{- Uplift safety factor} = \frac{\text{Pedestal} + \text{Footing} + \text{Cover} - \text{Buoyancy}}{\text{Uplift load}} = \frac{0.0 + 0.7 + 0.0 - 0.3}{0.0} = 99.99 > 1.00 \text{ OK}$$

ONE-WAY SHEAR CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

Concrete $f'_c = 2.5$ ksi

Steel $f_y = 40.0$ ksi

Soil density = 110 pcf

d Top X-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} / 2 = 8.0 - 2.0 - 0.8 / 2 = 5.6$ in

d Top Z-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} - \text{Z-diameter} / 2 = 8.0 - 2.0 - 0.8 - 0.8 / 2 = 4.9$ in

d Bot X-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} / 2 = 8.0 - 3.0 - 0.5 / 2 = 4.8$ in

d Bot Z-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} - \text{Z-diameter} / 2 = 8.0 - 3.0 - 0.5 - 0.5 / 2 = 4.3$ in

$\phi V_{cx} = 2 \cdot \phi \cdot \sqrt{f'_c} \cdot \text{Width} \cdot d / 1000 = 2 \cdot 0.75 \cdot \sqrt{(2500)} \cdot 3.5 \cdot 12 \cdot 4.8 / 1000 = 15.0$ kip

ACI Eq. (22.5.5.1)

$\phi V_{cz} = 2 \cdot \phi \cdot \sqrt{f'_c} \cdot \text{Length} \cdot d / 1000 = 2 \cdot 0.75 \cdot \sqrt{(2500)} \cdot 3.5 \cdot 12 \cdot 4.3 / 1000 = 13.4$ kip



- Shear forces calculated as the volume of the bearing pressures under the effective areas:

One-way shear V_{ux} (- Side) = 10.2 kip < 15.0 kip OK

One-way shear V_{ux} (+ Side) = 10.2 kip < 15.0 kip OK

One-way shear V_{uz} (- Side) = 10.2 kip < 13.4 kip OK

One-way shear V_{uz} (+ Side) = 10.2 kip < 13.4 kip OK

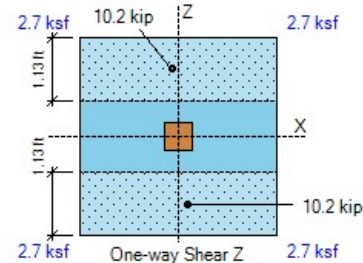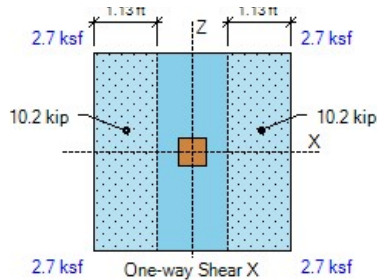

FLEXURE CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

$$\text{Plain } \phi M_{nx} = 5 * \phi * \sqrt{f_c} * L * \text{Thick}^2 / 6 = 5 * 0.60 * \sqrt{(2500)} * 3.50 * 8.0^2 / 6 / 1000 = 1.5 \text{ k-ft}$$

ACI Eq. (14.5.2.1a)

$$\text{Plain } \phi M_{nz} = 5 * \phi * \sqrt{f_c} * W * \text{Thick}^2 / 6 = 5 * 0.60 * \sqrt{(2500)} * 3.50 * 8.0^2 / 6 / 1000 = 1.5 \text{ k-ft}$$

- Top Bars

No Top Reinforcement Provided at the Footing

Use Plain Concrete Flexural Strength at Top

- Top moments calculated as the overburden minus the bearing pressures times the lever arm:

$$\text{Top moment -Mux (- Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

$$\text{Top moment -Mux (+ Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

$$\text{Top moment -Muz (- Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

$$\text{Top moment -Muz (+ Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

- Bottom Bars

$$\text{Use 5 \#4 Z-Bars } \rho = A_s / b d = 1.0 / (3.50 * 12 * 4.3) = 0.0056$$

$$q = 0.0056 * 40 / 2.5 = 0.090$$

$$\text{Use 5 \#4 X-Bars } \rho = A_s / b d = 1.0 / (3.50 * 12 * 4.8) = 0.0050$$

$$q = 0.0050 * 40 / 2.5 = 0.080$$

$$\beta = L / W = 3.50 / 3.50 = 1.00 \quad \gamma_s = 2 * \beta / (\beta + 1) = 2 * 1.00 / (1.00 + 1) = 1.00$$

ACI 13.3.3.3

$$\text{Bending strength } \phi M_n = \phi * b * d^2 * f_c * q * (1 - 0.59 * q)$$

ACI 22.2.2

$$\phi M_{nx} = 0.90 * 3.50 * 12 * 4.3^2 * 2.5 * 0.090 * (1 - 0.59 * 0.090) = 12.1 \text{ k-ft}$$

$$\phi M_{nz} = 0.90 * 3.50 * 12 * 4.8^2 * 2.5 * 0.080 / 1.00 * (1 - 0.59 * 0.080 / 1.00) = 13.6 \text{ k-ft}$$

- Bottom moments calculated as the bearing minus the overburden pressures times the lever arm:

$$\text{Bottom moment Mux (- Side)} = 10.2 \text{ k-ft} < 12.1 \text{ k-ft OK} \quad \text{ratio} = 0.84$$

$$\text{Bottom moment Mux (+ Side)} = 10.2 \text{ k-ft} < 12.1 \text{ k-ft OK} \quad \text{ratio} = 0.85$$

$$\text{Bottom moment Muz (- Side)} = 10.2 \text{ k-ft} < 13.6 \text{ k-ft OK} \quad \text{ratio} = 0.75$$

$$\text{Bottom moment Muz (+ Side)} = 10.2 \text{ k-ft} < 13.6 \text{ k-ft OK} \quad \text{ratio} = 0.75$$

$$\text{X-As min} = 0.0018 * \text{Width} * \text{Thick} = 0.0018 * 3.50 * 12 * 8.0 = 0.6 \text{ in}^2 < 1.0 \text{ in}^2 \text{ OK}$$

ACI 8.6.1.1

$$\text{Z-As min} = 0.0018 * \text{Length} * \text{Thick} = 0.0018 * 3.50 * 12 * 8.0 = 0.6 \text{ in}^2 < 1.0 \text{ in}^2 \text{ OK}$$

ACI 8.6.1.1

$$\text{X-As max for 0.005 tension strain} = 3.20 \text{ in}^2 > 1.00 \text{ in}^2 \text{ OK}$$

ACI 21.2.2

$$\text{Z-As max for 0.005 tension strain} = 3.20 \text{ in}^2 > 1.00 \text{ in}^2 \text{ OK}$$

ACI 21.2.2

$$\text{X-Cover factor} = \text{Min} (2.5, (\text{Cover} + db / 2, \text{Spacing} / 2) / db) = \text{Min} (2.5, (3.0 + 0.50 / 2, 9.0 / 2) / 0.50) = 2.5$$

$$\text{Straight X-Ld} = \text{Max} (12.0, 3 / 40 * f_y / (f_c)^{1/2} * \text{Grade} * \text{Size} * \text{Casting} / \text{Cover} * db * \text{ratio})$$

ACI Eq. (25.4.2.3a)

$$\text{X-Ld} = \text{Max} (12.0, 3 / 40 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.8 * 1.0 / 2.5 * 0.50 * 0.75) = 12.0 \text{ in}$$


$$\text{Hooked X-Ldh} = \text{Max} (8 db, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * db * \text{ratio}) =$$

ACI 25.4.3

$$\text{X-Ldh} = \text{Max} (8 db, 6, 0.02 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.50 * 0.75) = 6.0 \text{ in}$$

$$\text{-X Ld provided} = (\text{Length} - \text{Col}) / 2 + \text{Offset} - \text{Cover} = 3.50 * 12 / 2 + 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK}$$

$$\text{+X Ld provided} = (\text{Length} - \text{Col}) / 2 - \text{Offset} - \text{Cover} = 3.50 * 12 / 2 - 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK} \quad 4 \text{ of } 7$$



Pieruccioni Engineering and Construction, L

Project:

Engineer:

Descrip: Grid 5D Footing

Page # ____

8/23/2024

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

$$Z\text{-Cover factor} = \text{Min} (2.5, (\text{Cover} + db / 2, \text{Spacing} / 2) / db) = \text{Min} (2.5, (3.0 + 0.50 / 2, 9.0 / 2) / 0.50) = 2.5$$

$$\text{Straight } Z\text{-Ld} = \text{Max} (12.0, 3 / 40 * f_y / (f_c)^{1/2} * \text{Grade} * \text{Size} * \text{Casting} / \text{Cover} * db * \text{ratio})$$

ACI Eq. (25.4.2.3a)

$$Z\text{-Ld} = \text{Max} (12.0, 3 / 40 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.8 * 1.0 / 2.5 * 0.50 * 0.75) = 12.0 \text{ in}$$

$$\text{Hooked } Z\text{-Ldh} = \text{Max} (8 \text{ db}, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * db * \text{ratio}) =$$

ACI 25.4.3

$$Z\text{-Ldh} = \text{Max} (8 \text{ db}, 6, 0.02 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.50 * 0.85) = 6.0 \text{ in}$$



$$-Z \text{ Ld provided} = (\text{Width} - \text{Col}) / 2 + \text{Offset} - \text{Cover} = 3.50 * 12 / 2 + 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK}$$

$$+Z \text{ Ld provided} = (\text{Width} - \text{Col}) / 2 - \text{Offset} - \text{Cover} = 3.50 * 12 / 2 - 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK}$$

$$X\text{-bar spacing} = 9.0 \text{ in} < \text{Min} (3 * t, 18.0) = 18.0 \text{ in OK}$$

ACI 7.7.2.3

$$Z\text{-bar spacing} = 9.0 \text{ in} < \text{Min} (3 * t, 18.0) = 18.0 \text{ in OK}$$

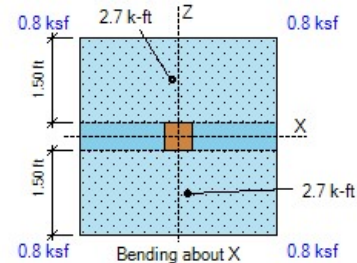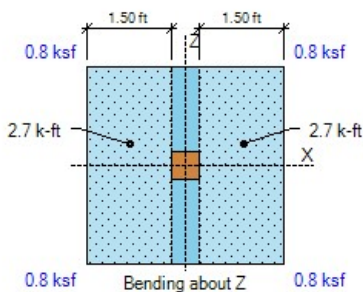

LOAD TRANSFER CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

$$\text{Area } A1 = \text{col } L * \text{col } W = 6.0 * 6.0 = 36.0 \text{ in}^2$$

$$Sx = \text{col } W * \text{col } L^2 / 6 = 6.0 * 6.0^2 / 6 = 36.0 \text{ in}^3$$

$$Sz = \text{col } L * \text{col } W^2 / 6 = 6.0 * 6.0^2 / 6 = 36.0 \text{ in}^3$$

$$\text{Bearing } Pbu = P / A1 + Mz / Sx + Mx / Sz = 31.7 / 36.0 + 0.0 * 12 / 36.0 + 0.0 * 12 / 36.0 = 0.9 \text{ ksi}$$

$$\text{Min edge} = \text{Min} (L / 2 - X\text{-offset} - \text{col } L / 2, W / 2 - Z\text{-offset} - \text{col } W / 2)$$

$$\text{Min edge} = \text{Min} (3.50 * 12 / 2 - 0.0 - 6.0 / 2, 3.50 * 12 / 2 - 0.0 - 6.0 / 2) = 18.0 \text{ in}$$

$$\text{Area } A2 = \text{Min} [L * W, (\text{col } L + 2 * \text{Min edge}) * (\text{col } W + 2 * \text{Min edge})]$$

ACI R22.8.3.2


$$A2 = \text{Min} [3.50 * 12 * 3.5 * 12, (6.0 + 2 * 18.0) * (6.0 + 2 * 18.0)] = 1764.0 \text{ in}^2$$

$$\text{Footing } \phi Pnc = \phi * 0.85 * f_c * \text{Min} [2, \sqrt{A2 / A1}] = 0.65 * 0.85 * 2.5 * \text{Min} [2, \sqrt{(1764.0 / 36.0)}] = 2.8 \text{ ksi}$$

$$\text{Footing } \phi Pns = \phi * As * Fy / A1 = 0.0 \text{ ksi}$$

ACI 22.8.3.2

$$\text{Footing bearing } \phi Pn = \phi Pnc + \phi Pns = 2.8 + 0.0 = 2.8 \text{ ksi} > 0.9 \text{ psi OK}$$



Pieruccioni Engineering and Construction, L

Project:

Page # ____

Engineer:

8/23/2024

Descrip: Grid 5D Footing

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

Hooked $L_{dh} = \text{Max} (8 \text{ db}, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * \text{db} * \text{ratio})$

ACI 25.4.3

$$L_{dh} = \text{Max} (8 \text{ db}, 6, 0.02 * 60.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.75 * 0.15) = 6.0 \text{ in}$$

Ld provided = Dowel length = $3.00 * 12 = 36.0 \text{ in} > 27.4 \text{ in OK}$

Ldh provided = Footing thickness - Cover = $8.00 - 3.0 = 5.0 \text{ in} < 6.0 \text{ in NG}$

PUNCHING SHEAR CALCULATIONS (Comb: 1.2D+1.6L+0.5Lr)

$$\text{X-Edge} = d/2 = 4.5/2 = 2.3 \text{ in} \quad \text{asx} = 20$$

$$\text{Z-Edge} = d/2 = 4.5/2 = 2.3 \text{ in} \quad \text{asz} = 20$$

$$\text{as} = \text{asx} + \text{asz} = 20 + 20 = 40 \quad \text{Col type} = \text{Interior} \quad \beta = L/W = 6.0/6.0 = 1.00$$

ACI 22.6.5.2

$$\text{Perimeter } b_o = \text{asx} / 10 * (L + d/2 + \text{X-Edge}) + \text{asz} / 10 * (W + d/2 + \text{Z-Edge})$$

ACI 22.6.4.2

$$b_o = 20 / 10 * (6.0 + 4.5/2 + 2.3) + 20 / 10 * (6.0 + 4.5/2 + 2.3) = 42.0 \text{ in}$$

$$\text{Area } A_{bo} = (L + d/2 + \text{X-Edge}) * (W + d/2 + \text{Z-Edge}) = (6.0 + 4.5/2 + 2.3) * (6.0 + 4.5/2 + 2.3) = 110.3 \text{ in}^2$$

$$\phi V_c = \phi * \text{Min} (2 + 4/\beta, \text{as} * d / b_o + 2, 4) * \sqrt{f_c}$$

ACI 22.6.5.2

$$\phi V_c = 0.75 * \text{Min} (2 + 4/1.00, 40 * 4.5 / 42.0 + 2, 4) * \sqrt{2500} = 150.0 \text{ psi}$$

Punching force $F = P + \text{Overburden} * A_{bo} - \text{Bearing}$

$$F = 31.7 + 0.07 * 110.3 / 144 - 2.0 = 29.7 \text{ kip}$$

$$b1 = L + d/2 + \text{X-Edge} = 6.0 + 4.5/2 + 2.3 = 10.5 \text{ in} \quad b2 = W + d/2 + \text{Z-Edge} = 6.0 + 4.5/2 + 2.3 = 10.5 \text{ in}$$

$$\gamma_{vx} \text{ factor} = 1 - \frac{1}{1 + (2/3) \sqrt{b2/b1}} = 1 - \frac{1}{1 + (2/3) \sqrt{10.5/10.5}} = 0.40$$

ACI Eq. (8.4.4.2.2)

$$\gamma_{vz} \text{ factor} = 1 - \frac{1}{1 + (2/3) \sqrt{b1/b2}} = 1 - \frac{1}{1 + (2/3) \sqrt{10.5/10.5}} = 0.40$$

ACI Eq. (8.4.2.3.2)

$$X2z = b1/2 = 10.5/2 = 5.3 \text{ in} \quad X2x = b2/2 = 10.5/2 = 5.3 \text{ in}$$

$$J_{cz} = b1 * d^3/6 + b1^3 * d/6 + b1^2 * b2 * d/2$$

ACI R8.4.4.2.3

$$J_{cz} = 10.5 * 4.5^3/6 + 10.5^3 * 4.5/6 + 10.5^2 * 10.5 * 4.5/2 = 3632 \text{ in}^4$$

$$J_{cx} = b2 * d^3/6 + b2^3 * d/6 + b2^2 * b1 * d/2$$

ACI R8.4.4.2.3


$$J_{cx} = 10.5 * 4.5^3/6 + 10.5^3 * 4.5/6 + 10.5^2 * 10.5 * 4.5/2 = 3632 \text{ in}^4$$


$$\text{Stress due to } P = F / (b_o * d) * 1000 = 29.7 / (42.0 * 4.5) * 1000 = 157.1 \text{ psi}$$

$$\text{Stress due to } M_x = \gamma_{vx} * X\text{-OTM} * X2x / J_{cx} = 0.40 * 0.0 * 12 * 5.3 / 3632 * 1000 = 0.0 \text{ psi}$$

$$\text{Stress due to } M_z = \gamma_{vz} * Z\text{-OTM} * X2z / J_{cz} = 0.40 * 0.0 * 12 * 5.3 / 3632 * 1000 = 0.0 \text{ psi}$$

$$\text{Punching stress} = P\text{-stress} + M_x\text{-stress} + M_z\text{-stress} = 157.1 + 0.0 + 0.0 = 157.1 \text{ psi} > 150.0 \text{ psi NG}$$

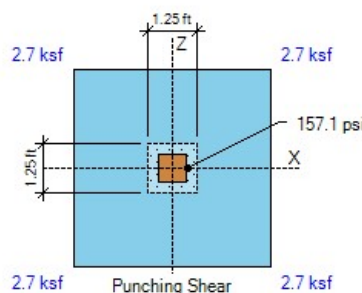



Pieruccioni Engineering and Construction, L

Project:

Engineer:

Descrip: Grid 5D Footing

Page # ____

8/23/2024

ASDIP Foundation 5.3.0.0


SPREAD FOOTING DESIGN


www.asdipsoft.com

DESIGN CODES

Concrete Design ACI 318-14

Load Combinations ASCE 7-10/16

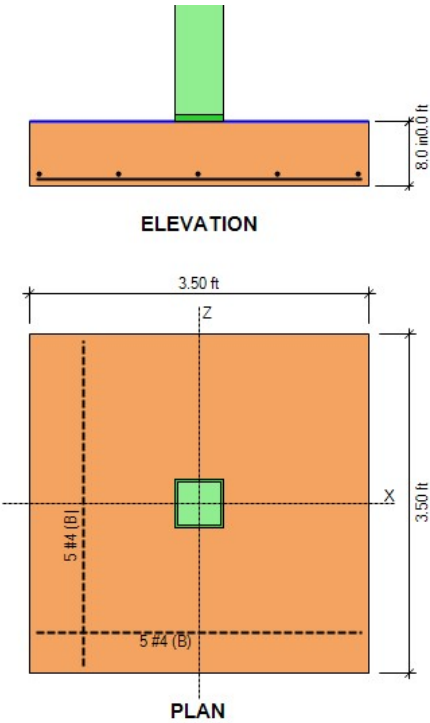



Pieruccioni Engineering and Construction, L

Project:

Page # _____

Engineer:

8/23/2024

Descrip: Grid 9D Footing

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

GEOMETRY

| | | | |
|------------------------------|-----------|----|----|
| Footing Length (X-dir) | 3.50 | ft | |
| Footing Width (Z-dir) | 3.50 | ft | |
| Footing Thickness | 8.0 | in | OK |
| Soil Cover | 0.00 | ft | |
| Column Length (X-dir) | 6.0 | in | |
| Column Width (Z-dir) | 6.0 | in | |
| Offset (X-dir) | 0.00 | in | OK |
| Offset (Z-dir) | 0.00 | in | OK |
| Base Plate (L x W) | 6.0 x 6.0 | in | |

SOIL PRESSURES (D+L)

| | | | |
|--------------------------------------|-------|-----|----|
| Gross Allow. Soil Pressure | 2.0 | ksf | |
| Soil Pressure at Corner 1 | 1.8 | ksf | |
| Soil Pressure at Corner 2 | 1.8 | ksf | |
| Soil Pressure at Corner 3 | 1.8 | ksf | |
| Soil Pressure at Corner 4 | 1.8 | ksf | |
| Bearing Pressure Ratio | 0.90 | | OK |
| Ftg. Area in Contact with Soil | 100.0 | % | |
| X-eccentricity / Ftg. Length | 0.00 | | OK |
| Z-eccentricity / Ftg. Width | 0.00 | | OK |

APPLIED LOADS

| | Dead | Live | RLive | Snow | Wind | Seismic | |
|----------------------|------|------|-------|------|------|---------|------|
| Axial Force P | 6.0 | 15.3 | 0.0 | 0.0 | 0.0 | 0.0 | kip |
| Moment about X Mx .. | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | k-ft |
| Moment about Z Mz .. | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | k-ft |
| Shear Force Vx | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | kip |
| Shear Force Vz | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | kip |

OVERTURNING CALCULATIONS (Comb: 0.6D+0.6W)

- Overturning about X-X

- Moment Mx = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 k-ft

- Shear Force Vz = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 kip

Arm = 0.00 + 8.0 / 12 = 0.67 ft

Moment = 0.0 * 0.67 = 0.0 k-ft

- Passive Force = 0.0 kip

Arm = 0.27 ft

Moment = 0.0 k-ft

- Overturning moment X-X = 0.0 + 0.0 = 0.0 k-ft

- Resisting about X-X

- Footing weight = $0.6 * W * L * Thick * Density = 0.6 * 3.50 * 3.50 * 8.0 / 12 * 0.15 = 0.7$ kip

Arm = $W / 2 = 3.50 / 2 = 1.75$ ft

Moment = $0.7 * 1.75 = 1.3$ k-ft

- Pedestal weight = $0.6 * W * L * H * Density = 0.6 * 6.0 / 12 * 6.0 / 12 * 0.0 * 0.15 = 0.0$ kip

Arm = $W / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75$ ft

Moment = $0.0 * 1.75 = 0.0$ k-ft

- Soil cover = $0.6 * W * L * SC * Density = 0.6 * (3.50 * 3.50 - 6.0 / 12 * 6.0 / 12) * 0.0 * 110 = 0.0$ kip

Arm = $W / 2 = 3.50 / 2 = 1.75$ ft

Moment = $0.0 * 1.75 = 0.0$ k-ft

- Buoyancy = $0.6 * W * L * \gamma * (SC + Thick - WT) = 0.6 * 3.50 * 3.50 * 62 * (0.67) = -0.3$ kip

Arm = $W / 2 = 3.50 / 2 = 1.75$ ft

Moment = $0.3 * 1.75 = -0.5$ k-ft


- Axial force P = $0.6 * 6.0 + 0.6 * 0.0 = 3.6$ kip

Arm = $W / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75$ ft

Moment = $3.6 * 1.75 = 6.3$ k-ft

- Resisting moment X-X = $1.3 + 0.0 + 0.0 + 6.3 + -0.5 = 7.1$ k-ft

- Overturning safety factor X-X = $\frac{Resisting\ moment}{Overturning\ moment} = \frac{7.1}{0.0} = 70.51 > 1.50$ OK



Pieruccioni Engineering and Construction, L

Project:

Engineer:

Descrip: Grid 9D Footing

Page # ____

8/23/2024

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

- Overturning about Z-Z

$$\text{- Moment } M_z = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 \text{ k-ft}$$

$$\text{- Shear Force } V_x = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 \text{ kip}$$

$$\text{Arm} = 0.00 + 8.0 / 12 = 0.67 \text{ ft}$$

$$\text{Moment} = 0.0 * 0.67 = 0.0 \text{ k-ft}$$

$$\text{- Passive Force} = 0.0 \text{ kip}$$

$$\text{Arm} = 0.27 \text{ ft}$$

$$\text{Moment} = 0.0 \text{ k-ft}$$

$$\text{- Overturning moment Z-Z} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

- Resisting about Z-Z

$$\text{- Footing weight} = 0.6 * W * L * Thick * Density = 0.6 * 3.50 * 3.50 * 8.0 / 12 * 0.15 = 0.7 \text{ kip}$$

$$\text{Arm} = L / 2 = 3.50 / 2 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.7 * 1.75 = 1.3 \text{ k-ft}$$

$$\text{- Pedestal weight} = 0.6 * W * L * H * Density = 0.6 * 6.0 / 12 * 6.0 / 12 * 0.0 * 0.15 = 0.0 \text{ kip}$$

$$\text{Arm} = L / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.0 * 1.75 = 0.0 \text{ k-ft}$$

$$\text{- Soil cover} = 0.6 * W * L * SC * Density = 0.6 * (3.50 * 3.50 - 6.0 / 12 * 6.0 / 12) * 0.0 * 110 = 0.0 \text{ kip}$$

$$\text{Arm} = L / 2 = 3.50 / 2 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.0 * 1.75 = 0.0 \text{ k-ft}$$

$$\text{- Buoyancy} = 0.6 * W * L * \gamma * (SC + Thick - WT) = 0.6 * 3.50 * 3.50 * 62 * (0.67) = -0.3 \text{ kip}$$

$$\text{Arm} = L / 2 = 3.50 / 2 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.3 * 1.75 = -0.5 \text{ k-ft}$$

$$\text{- Axial force } P = 0.6 * 6.0 + 0.6 * 0.0 = 3.6 \text{ kip}$$

$$\text{Arm} = L / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75 \text{ ft}$$

$$\text{Moment} = 3.6 * 1.75 = 6.3 \text{ k-ft}$$

$$\text{- Resisting moment Z-Z} = 1.3 + 0.0 + 0.0 + 6.3 + -0.5 = 7.1 \text{ k-ft}$$

$$\text{- Overturning safety factor Z-Z} = \frac{\text{Resisting moment}}{\text{Overturning moment}} = \frac{7.1}{0.0} = 70.51 > 1.50 \text{ OK}$$

SOIL BEARING PRESSURES (Comb: D+L)

$$\text{Overturning moment X-X} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

$$\text{Resisting moment X-X} = 2.1 + 0.0 + 0.0 + -0.9 + 37.3 = 38.5 \text{ k-ft}$$

$$\text{Overturning moment Z-Z} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

$$\text{Resisting moment Z-Z} = 2.1 + 0.0 + 0.0 + -0.9 + 37.3 = 38.5 \text{ k-ft}$$

$$\text{Resisting force} = \text{Footing} + \text{Pedestal} + \text{Soil} - \text{Buoyancy} + P = 1.2 + 0.0 + 0.0 - 0.5 + 21.3 = 22.0 \text{ kip}$$

X-coordinate of resultant from maximum bearing corner:

$$X_p = \frac{Z\text{-Resisting moment} - Z\text{-Overturning moment}}{\text{Resisting force}} = \frac{38.5 - 0.0}{22.0} = 1.75 \text{ ft}$$

Z-coordinate of resultant from maximum bearing corner:

$$Z_p = \frac{X\text{-Resisting moment} - X\text{-Overturning moment}}{\text{Resisting force}} = \frac{38.5 - 0.0}{22.0} = 1.75 \text{ ft}$$

$$X\text{-ecc} = \text{Length} / 2 - X_p = 3.50 / 2 - 1.75 = 0.00 \text{ ft}$$

$$Z\text{-ecc} = \text{Width} / 2 - Z_p = 3.50 / 2 - 1.75 = 0.00 \text{ ft}$$

$$\text{Area} = \text{Width} * \text{Length} = 3.50 * 3.50 = 12.3 \text{ ft}^2$$

$$S_x = \text{Length} * \text{Width}^2 / 6 = 3.50 * 3.50^2 / 6 = 7.1 \text{ ft}^3$$

$$S_z = \text{Width} * \text{Length}^2 / 6 = 3.50 * 3.50^2 / 6 = 7.1 \text{ ft}^3$$



- Footing is in full bearing. Soil pressures are as follows:

$$P1 = P * (1/A + Z\text{-ecc} / S_x + X\text{-ecc} / S_z) = 22.0 * (1 / 12.3 + 0.00 / 7.1 + 0.00 / 7.1) = 1.80 \text{ ksf}$$

$$P2 = P * (1/A - Z\text{-ecc} / S_x + X\text{-ecc} / S_z) = 22.0 * (1 / 12.3 - 0.00 / 7.1 + 0.00 / 7.1) = 1.80 \text{ ksf}$$

$$P3 = P * (1/A - Z\text{-ecc} / S_x - X\text{-ecc} / S_z) = 22.0 * (1 / 12.3 - 0.00 / 7.1 - 0.00 / 7.1) = 1.80 \text{ ksf}$$

$$P4 = P * (1/A + Z\text{-ecc} / S_x - X\text{-ecc} / S_z) = 22.0 * (1 / 12.3 + 0.00 / 7.1 - 0.00 / 7.1) = 1.80 \text{ ksf}$$

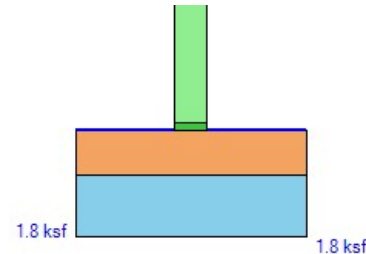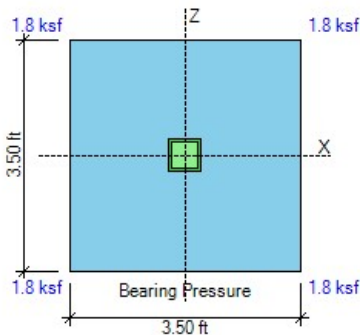

SLIDING CALCULATIONS (Comb: 0.6D+0.6W)

Internal friction angle = 28.0 deg

Passive coefficient $k_p = 4.33$ (per Coulomb)

Pressure at mid-depth = $k_p \cdot \text{Density} \cdot (\text{Cover} + \text{Thick} / 2) = 4.33 \cdot 110 \cdot (0.00 + 8.0 / 12 / 2) = 0.16$ ksf

X-Passive force = $\text{Pressure} \cdot \text{Thick} \cdot \text{Width} = 0.16 \cdot 8.0 / 12 \cdot 3.50 = 0.4$ kip

Z-Passive force = $\text{Pressure} \cdot \text{Thick} \cdot \text{Length} = 0.16 \cdot 8.0 / 12 \cdot 3.50 = 0.4$ kip

Friction force = $\text{Resisting force} \cdot \text{Friction coeff.} = \text{Max}(0, 4.0 \cdot 0.35) = 1.4$ kip

Use 100% of Passive + 100% of Friction for sliding resistance

$$\text{- Sliding safety factor X-X} = \frac{\text{X-Passive force} + \text{Friction}}{\text{X-Horizontal load}} = \frac{1.00 \cdot 0.4 + 1.00 \cdot 1.4}{0.0} = 17.80 > 1.50 \text{ OK}$$

$$\text{- Sliding safety factor Z-Z} = \frac{\text{Z-Passive force} + \text{Friction}}{\text{Z-Horizontal load}} = \frac{1.00 \cdot 0.4 + 1.00 \cdot 1.4}{0.0} = 17.80 > 1.50 \text{ OK}$$

UPLIFT CALCULATIONS (Comb: 0.6D+0.6W)

$$\text{- Uplift safety factor} = \frac{\text{Pedestal} + \text{Footing} + \text{Cover} - \text{Buoyancy}}{\text{Uplift load}} = \frac{0.0 + 0.7 + 0.0 - 0.3}{0.0} = 99.99 > 1.00 \text{ OK}$$

ONE-WAY SHEAR CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

Concrete $f'_c = 2.5$ ksi

Steel $f_y = 40.0$ ksi

Soil density = 110 pcf

d Top X-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} / 2 = 8.0 - 2.0 - 0.8 / 2 = 5.6$ in

d Top Z-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} - \text{Z-diameter} / 2 = 8.0 - 2.0 - 0.8 - 0.8 / 2 = 4.9$ in

d Bot X-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} / 2 = 8.0 - 3.0 - 0.5 / 2 = 4.8$ in

d Bot Z-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} - \text{Z-diameter} / 2 = 8.0 - 3.0 - 0.5 - 0.5 / 2 = 4.3$ in

$\phi V_{cx} = 2 \cdot \phi \cdot \sqrt{f'_c} \cdot \text{Width} \cdot d / 1000 = 2 \cdot 0.75 \cdot \sqrt{(2500)} \cdot 3.5 \cdot 12 \cdot 4.8 / 1000 = 15.0$ kip

ACI Eq. (22.5.5.1)

$\phi V_{cz} = 2 \cdot \phi \cdot \sqrt{f'_c} \cdot \text{Length} \cdot d / 1000 = 2 \cdot 0.75 \cdot \sqrt{(2500)} \cdot 3.5 \cdot 12 \cdot 4.3 / 1000 = 13.4$ kip



- Shear forces calculated as the volume of the bearing pressures under the effective areas:

One-way shear V_{ux} (- Side) = 10.2 kip < 15.0 kip OK

One-way shear V_{ux} (+ Side) = 10.2 kip < 15.0 kip OK

One-way shear V_{uz} (- Side) = 10.2 kip < 13.4 kip OK

One-way shear V_{uz} (+ Side) = 10.2 kip < 13.4 kip OK

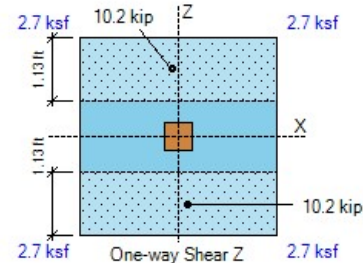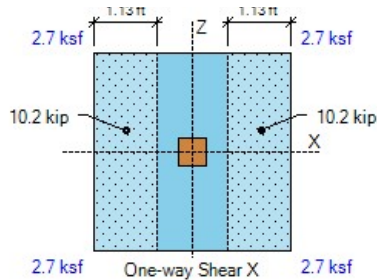

FLEXURE CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

$$\text{Plain } \phi M_{nx} = 5 * \phi * \sqrt{f_c} * L * \text{Thick}^2 / 6 = 5 * 0.60 * \sqrt{(2500)} * 3.50 * 8.0^2 / 6 / 1000 = 1.5 \text{ k-ft}$$

ACI Eq. (14.5.2.1a)

$$\text{Plain } \phi M_{nz} = 5 * \phi * \sqrt{f_c} * W * \text{Thick}^2 / 6 = 5 * 0.60 * \sqrt{(2500)} * 3.50 * 8.0^2 / 6 / 1000 = 1.5 \text{ k-ft}$$

- Top Bars

No Top Reinforcement Provided at the Footing

Use Plain Concrete Flexural Strength at Top

- Top moments calculated as the overburden minus the bearing pressures times the lever arm:

$$\text{Top moment -Mux (- Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

$$\text{Top moment -Mux (+ Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

$$\text{Top moment -Muz (- Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

$$\text{Top moment -Muz (+ Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

- Bottom Bars

$$\text{Use 5 \#4 Z-Bars } \rho = A_s / b d = 1.0 / (3.50 * 12 * 4.3) = 0.0056$$

$$q = 0.0056 * 40 / 2.5 = 0.090$$

$$\text{Use 5 \#4 X-Bars } \rho = A_s / b d = 1.0 / (3.50 * 12 * 4.8) = 0.0050$$

$$q = 0.0050 * 40 / 2.5 = 0.080$$

$$\beta = L / W = 3.50 / 3.50 = 1.00 \quad \gamma_s = 2 * \beta / (\beta + 1) = 2 * 1.00 / (1.00 + 1) = 1.00$$

ACI 13.3.3.3

$$\text{Bending strength } \phi M_n = \phi * b * d^2 * f_c * q * (1 - 0.59 * q)$$

ACI 22.2.2

$$\phi M_{nx} = 0.90 * 3.50 * 12 * 4.3^2 * 2.5 * 0.090 * (1 - 0.59 * 0.090) = 12.1 \text{ k-ft}$$

$$\phi M_{nz} = 0.90 * 3.50 * 12 * 4.8^2 * 2.5 * 0.080 / 1.00 * (1 - 0.59 * 0.080 / 1.00) = 13.6 \text{ k-ft}$$

- Bottom moments calculated as the bearing minus the overburden pressures times the lever arm:

$$\text{Bottom moment Mux (- Side)} = 10.2 \text{ k-ft} < 12.1 \text{ k-ft OK} \quad \text{ratio} = 0.84$$

$$\text{Bottom moment Mux (+ Side)} = 10.2 \text{ k-ft} < 12.1 \text{ k-ft OK} \quad \text{ratio} = 0.85$$

$$\text{Bottom moment Muz (- Side)} = 10.2 \text{ k-ft} < 13.6 \text{ k-ft OK} \quad \text{ratio} = 0.75$$

$$\text{Bottom moment Muz (+ Side)} = 10.2 \text{ k-ft} < 13.6 \text{ k-ft OK} \quad \text{ratio} = 0.75$$

$$\text{X-As min} = 0.0018 * \text{Width} * \text{Thick} = 0.0018 * 3.50 * 12 * 8.0 = 0.6 \text{ in}^2 < 1.0 \text{ in}^2 \text{ OK}$$

ACI 8.6.1.1

$$\text{Z-As min} = 0.0018 * \text{Length} * \text{Thick} = 0.0018 * 3.50 * 12 * 8.0 = 0.6 \text{ in}^2 < 1.0 \text{ in}^2 \text{ OK}$$

ACI 8.6.1.1

$$\text{X-As max for 0.005 tension strain} = 3.20 \text{ in}^2 > 1.00 \text{ in}^2 \text{ OK}$$

ACI 21.2.2

$$\text{Z-As max for 0.005 tension strain} = 3.20 \text{ in}^2 > 1.00 \text{ in}^2 \text{ OK}$$

ACI 21.2.2

$$\text{X-Cover factor} = \text{Min} (2.5, (\text{Cover} + db / 2, \text{Spacing} / 2) / db) = \text{Min} (2.5, (3.0 + 0.50 / 2, 9.0 / 2) / 0.50) = 2.5$$

$$\text{Straight X-Ld} = \text{Max} (12.0, 3 / 40 * f_y / (f_c)^{1/2} * \text{Grade} * \text{Size} * \text{Casting} / \text{Cover} * db * \text{ratio})$$

ACI Eq. (25.4.2.3a)

$$\text{X-Ld} = \text{Max} (12.0, 3 / 40 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.8 * 1.0 / 2.5 * 0.50 * 0.75) = 12.0 \text{ in}$$


$$\text{Hooked X-Ldh} = \text{Max} (8 db, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * db * \text{ratio}) =$$

ACI 25.4.3

$$\text{X-Ldh} = \text{Max} (8 db, 6, 0.02 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.50 * 0.75) = 6.0 \text{ in}$$

$$\text{-X Ld provided} = (\text{Length} - \text{Col}) / 2 + \text{Offset} - \text{Cover} = 3.50 * 12 / 2 + 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK}$$

$$\text{+X Ld provided} = (\text{Length} - \text{Col}) / 2 - \text{Offset} - \text{Cover} = 3.50 * 12 / 2 - 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK} \quad 4 \text{ of } 7$$



Pieruccioni Engineering and Construction, L

Project:

Engineer:

Descrip: Grid 9D Footing

Page # ____

8/23/2024

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

$$Z\text{-Cover factor} = \text{Min} (2.5, (\text{Cover} + db / 2, \text{Spacing} / 2) / db) = \text{Min} (2.5, (3.0 + 0.50 / 2, 9.0 / 2) / 0.50) = 2.5$$

$$\text{Straight } Z\text{-Ld} = \text{Max} (12.0, 3 / 40 * f_y / (f_c)^{1/2} * \text{Grade} * \text{Size} * \text{Casting} / \text{Cover} * db * \text{ratio})$$

ACI Eq. (25.4.2.3a)

$$Z\text{-Ld} = \text{Max} (12.0, 3 / 40 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.8 * 1.0 / 2.5 * 0.50 * 0.75) = 12.0 \text{ in}$$

$$\text{Hooked } Z\text{-Ldh} = \text{Max} (8 \text{ db}, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * db * \text{ratio}) =$$

ACI 25.4.3

$$Z\text{-Ldh} = \text{Max} (8 \text{ db}, 6, 0.02 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.50 * 0.85) = 6.0 \text{ in}$$



$$-Z \text{ Ld provided} = (\text{Width} - \text{Col}) / 2 + \text{Offset} - \text{Cover} = 3.50 * 12 / 2 + 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK}$$

$$+Z \text{ Ld provided} = (\text{Width} - \text{Col}) / 2 - \text{Offset} - \text{Cover} = 3.50 * 12 / 2 - 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK}$$

$$X\text{-bar spacing} = 9.0 \text{ in} < \text{Min} (3 * t, 18.0) = 18.0 \text{ in OK}$$

ACI 7.7.2.3

$$Z\text{-bar spacing} = 9.0 \text{ in} < \text{Min} (3 * t, 18.0) = 18.0 \text{ in OK}$$

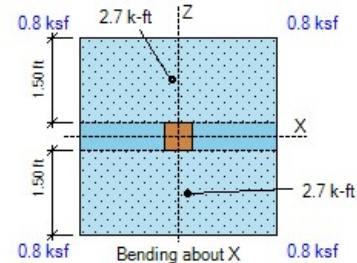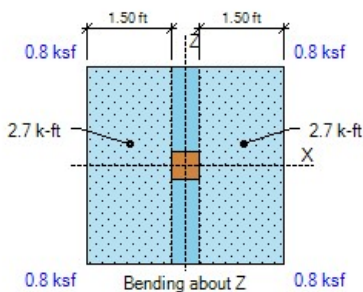

LOAD TRANSFER CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

$$\text{Area } A1 = \text{col } L * \text{col } W = 6.0 * 6.0 = 36.0 \text{ in}^2$$

$$Sx = \text{col } W * \text{col } L^2 / 6 = 6.0 * 6.0^2 / 6 = 36.0 \text{ in}^3$$

$$Sz = \text{col } L * \text{col } W^2 / 6 = 6.0 * 6.0^2 / 6 = 36.0 \text{ in}^3$$

$$\text{Bearing } Pbu = P / A1 + Mz / Sx + Mx / Sz = 31.7 / 36.0 + 0.0 * 12 / 36.0 + 0.0 * 12 / 36.0 = 0.9 \text{ ksi}$$

$$\text{Min edge} = \text{Min} (L / 2 - X\text{-offset} - \text{col } L / 2, W / 2 - Z\text{-offset} - \text{col } W / 2)$$

$$\text{Min edge} = \text{Min} (3.50 * 12 / 2 - 0.0 - 6.0 / 2, 3.50 * 12 / 2 - 0.0 - 6.0 / 2) = 18.0 \text{ in}$$

$$\text{Area } A2 = \text{Min} [L * W, (\text{col } L + 2 * \text{Min edge}) * (\text{col } W + 2 * \text{Min edge})]$$

ACI R22.8.3.2


$$A2 = \text{Min} [3.50 * 12 * 3.5 * 12, (6.0 + 2 * 18.0) * (6.0 + 2 * 18.0)] = 1764.0 \text{ in}^2$$

$$\text{Footing } \phi Pnc = \phi * 0.85 * f_c * \text{Min} [2, \sqrt{A2 / A1}] = 0.65 * 0.85 * 2.5 * \text{Min} [2, \sqrt{(1764.0 / 36.0)}] = 2.8 \text{ ksi}$$

$$\text{Footing } \phi Pns = \phi * As * Fy / A1 = 0.0 \text{ ksi}$$

ACI 22.8.3.2

$$\text{Footing bearing } \phi Pn = \phi Pnc + \phi Pns = 2.8 + 0.0 = 2.8 \text{ ksi} > 0.9 \text{ psi OK}$$



Pieruccioni Engineering and Construction, L

Project:

Engineer:

Descrip: Grid 9D Footing

Page # ____

8/23/2024

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

Hooked $L_{dh} = \text{Max} (8 \text{ db}, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * \text{db} * \text{ratio})$

ACI 25.4.3

$$L_{dh} = \text{Max} (8 \text{ db}, 6, 0.02 * 60.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.75 * 0.15) = 6.0 \text{ in}$$

Ld provided = Dowel length = $3.00 * 12 = 36.0 \text{ in} > 27.4 \text{ in OK}$

Ldh provided = Footing thickness - Cover = $8.00 - 3.0 = 5.0 \text{ in} < 6.0 \text{ in NG}$

PUNCHING SHEAR CALCULATIONS (Comb: 1.2D+1.6L+0.5Lr)

$$\text{X-Edge} = d/2 = 4.5 / 2 = 2.3 \text{ in} \quad \text{asx} = 20$$

$$\text{Z-Edge} = d/2 = 4.5 / 2 = 2.3 \text{ in} \quad \text{asz} = 20$$

$$\text{as} = \text{asx} + \text{asz} = 20 + 20 = 40 \quad \text{Col type} = \text{Interior} \quad \beta = L/W = 6.0 / 6.0 = 1.00$$

ACI 22.6.5.2

$$\text{Perimeter } b_o = \text{asx} / 10 * (L + d/2 + \text{X-Edge}) + \text{asx} / 10 * (W + d/2 + \text{Z-Edge})$$

ACI 22.6.4.2

$$b_o = 20 / 10 * (6.0 + 4.5 / 2 + 2.3) + 20 / 10 * (6.0 + 4.5 / 2 + 2.3) = 42.0 \text{ in}$$

$$\text{Area } A_{bo} = (L + d/2 + \text{X-Edge}) * (W + d/2 + \text{Z-Edge}) = (6.0 + 4.5 / 2 + 2.3) * (6.0 + 4.5 / 2 + 2.3) = 110.3 \text{ in}^2$$

$$\phi V_c = \phi * \text{Min} (2 + 4/\beta, \text{as} * d / b_o + 2, 4) * \sqrt{f_c}$$

ACI 22.6.5.2

$$\phi V_c = 0.75 * \text{Min} (2 + 4 / 1.00, 40 * 4.5 / 42.0 + 2, 4) * \sqrt{2500} = 150.0 \text{ psi}$$

Punching force $F = P + \text{Overburden} * A_{bo} - \text{Bearing}$

$$F = 31.7 + 0.07 * 110.3 / 144 - 2.0 = 29.7 \text{ kip}$$

$$b1 = L + d/2 + \text{X-Edge} = 6.0 + 4.5 / 2 + 2.3 = 10.5 \text{ in} \quad b2 = W + d/2 + \text{Z-Edge} = 6.0 + 4.5 / 2 + 2.3 = 10.5 \text{ in}$$

$$\gamma_{vx} \text{ factor} = 1 - \frac{1}{1 + (2/3) \sqrt{b2/b1}} = 1 - \frac{1}{1 + (2/3) \sqrt{10.5/10.5}} = 0.40$$

ACI Eq. (8.4.4.2.2)

$$\gamma_{vz} \text{ factor} = 1 - \frac{1}{1 + (2/3) \sqrt{b1/b2}} = 1 - \frac{1}{1 + (2/3) \sqrt{10.5/10.5}} = 0.40$$

ACI Eq. (8.4.2.3.2)

$$X2z = b1/2 = 10.5/2 = 5.3 \text{ in} \quad X2x = b2/2 = 10.5/2 = 5.3 \text{ in}$$

$$J_{cz} = b1 * d^3 / 6 + b1^3 * d / 6 + b1^2 * b2 * d / 2$$

ACI R8.4.4.2.3

$$J_{cz} = 10.5 * 4.5^3 / 6 + 10.5^3 * 4.5 / 6 + 10.5^2 * 10.5 * 4.5 / 2 = 3632 \text{ in}^4$$

$$J_{cx} = b2 * d^3 / 6 + b2^3 * d / 6 + b2^2 * b1 * d / 2$$

ACI R8.4.4.2.3


$$J_{cx} = 10.5 * 4.5^3 / 6 + 10.5^3 * 4.5 / 6 + 10.5^2 * 10.5 * 4.5 / 2 = 3632 \text{ in}^4$$


$$\text{Stress due to } P = F / (b_o * d) * 1000 = 29.7 / (42.0 * 4.5) * 1000 = 157.1 \text{ psi}$$

$$\text{Stress due to } M_x = \gamma_{vx} * X\text{-OTM} * X2x / J_{cx} = 0.40 * 0.0 * 12 * 5.3 / 3632 * 1000 = 0.0 \text{ psi}$$

$$\text{Stress due to } M_z = \gamma_{vz} * Z\text{-OTM} * X2z / J_{cz} = 0.40 * 0.0 * 12 * 5.3 / 3632 * 1000 = 0.0 \text{ psi}$$

$$\text{Punching stress} = P\text{-stress} + M_x\text{-stress} + M_z\text{-stress} = 157.1 + 0.0 + 0.0 = 157.1 \text{ psi} > 150.0 \text{ psi NG}$$

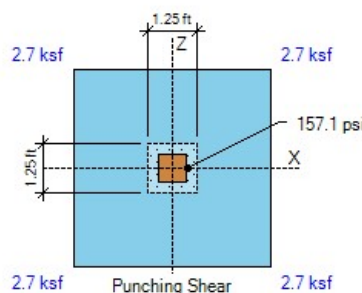



Pieruccioni Engineering and Construction, L

Project:

Engineer:

Descrip: Grid 9D Footing

Page # ____

8/23/2024

ASDIP Foundation 5.3.0.0


SPREAD FOOTING DESIGN


www.asdipsoft.com

DESIGN CODES

Concrete Design ACI 318-14

Load Combinations ASCE 7-10/16

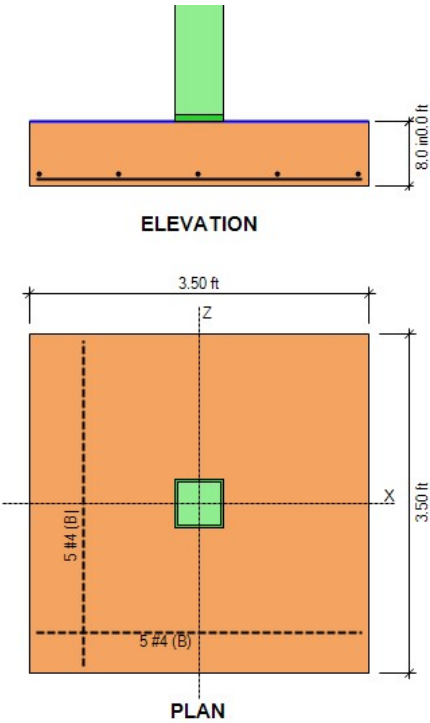



Pieruccioni Engineering and Construction, L

Project:

Page # _____

Engineer:

8/23/2024

Descrip: Grid 10D Footing

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

GEOMETRY

| | | | |
|------------------------------|-----------|----|----|
| Footing Length (X-dir) | 3.50 | ft | |
| Footing Width (Z-dir) | 3.50 | ft | |
| Footing Thickness | 8.0 | in | OK |
| Soil Cover | 0.00 | ft | |
| Column Length (X-dir) | 6.0 | in | |
| Column Width (Z-dir) | 6.0 | in | |
| Offset (X-dir) | 0.00 | in | OK |
| Offset (Z-dir) | 0.00 | in | OK |
| Base Plate (L x W) | 6.0 x 6.0 | in | |

SOIL PRESSURES (D+L)

| | | | |
|--------------------------------------|-------|-----|----|
| Gross Allow. Soil Pressure | 2.0 | ksf | |
| Soil Pressure at Corner 1 | 1.5 | ksf | |
| Soil Pressure at Corner 2 | 1.5 | ksf | |
| Soil Pressure at Corner 3 | 1.5 | ksf | |
| Soil Pressure at Corner 4 | 1.5 | ksf | |
| Bearing Pressure Ratio | 0.76 | | OK |
| Ftg. Area in Contact with Soil | 100.0 | % | |
| X-eccentricity / Ftg. Length | 0.00 | | OK |
| Z-eccentricity / Ftg. Width | 0.00 | | OK |

APPLIED LOADS

| | Dead | Live | RLive | Snow | Wind | Seismic | |
|----------------------|------|------|-------|------|------|---------|------|
| Axial Force P | 5.2 | 12.8 | 0.0 | 0.0 | 0.0 | 0.0 | kip |
| Moment about X Mx .. | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | k-ft |
| Moment about Z Mz .. | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | k-ft |
| Shear Force Vx | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | kip |
| Shear Force Vz | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | kip |

OVERTURNING CALCULATIONS (Comb: 0.6D+0.6W)

- Overturning about X-X

- Moment Mx = $0.6 * 0.0 + 0.6 * 0.0 = 0.0$ k-ft

- Shear Force Vz = $0.6 * 0.0 + 0.6 * 0.0 = 0.0$ kip

Arm = $0.00 + 8.0 / 12 = 0.67$ ft

Moment = $0.0 * 0.67 = 0.0$ k-ft

- Passive Force = 0.0 kip

Arm = 0.27 ft

Moment = 0.0 k-ft

- Overturning moment X-X = $0.0 + 0.0 = 0.0$ k-ft

- Resisting about X-X

- Footing weight = $0.6 * W * L * Thick * Density = 0.6 * 3.50 * 3.50 * 8.0 / 12 * 0.15 = 0.7$ kip

Arm = $W / 2 = 3.50 / 2 = 1.75$ ft

Moment = $0.7 * 1.75 = 1.3$ k-ft

- Pedestal weight = $0.6 * W * L * H * Density = 0.6 * 6.0 / 12 * 6.0 / 12 * 0.0 * 0.15 = 0.0$ kip

Arm = $W / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75$ ft

Moment = $0.0 * 1.75 = 0.0$ k-ft

- Soil cover = $0.6 * W * L * SC * Density = 0.6 * (3.50 * 3.50 - 6.0 / 12 * 6.0 / 12) * 0.0 * 110 = 0.0$ kip

Arm = $W / 2 = 3.50 / 2 = 1.75$ ft

Moment = $0.0 * 1.75 = 0.0$ k-ft

- Buoyancy = $0.6 * W * L * \gamma * (SC + Thick - WT) = 0.6 * 3.50 * 3.50 * 62 * (0.67) = -0.3$ kip

Arm = $W / 2 = 3.50 / 2 = 1.75$ ft

Moment = $0.3 * 1.75 = -0.5$ k-ft


- Axial force P = $0.6 * 5.2 + 0.6 * 0.0 = 3.1$ kip

Arm = $W / 2 - Offset = 3.50 / 2 - 0.0 / 12 = 1.75$ ft

Moment = $3.1 * 1.75 = 5.5$ k-ft

- Resisting moment X-X = $1.3 + 0.0 + 0.0 + 5.5 + -0.5 = 6.2$ k-ft

- Overturning safety factor X-X = $\frac{Resisting\ moment}{Overturning\ moment} = \frac{6.2}{0.0} = 62.11 > 1.50$ OK



Pieruccioni Engineering and Construction, L

Project:

Engineer:

Descrip: Grid 10D Footing

Page # ____

8/23/2024

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

- Overturning about Z-Z

$$\text{- Moment } M_z = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 \text{ k-ft}$$

$$\text{- Shear Force } V_x = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 \text{ kip}$$

$$\text{Arm} = 0.00 + 8.0 / 12 = 0.67 \text{ ft}$$

$$\text{Moment} = 0.0 * 0.67 = 0.0 \text{ k-ft}$$

$$\text{- Passive Force} = 0.0 \text{ kip}$$

$$\text{Arm} = 0.27 \text{ ft}$$

$$\text{Moment} = 0.0 \text{ k-ft}$$

$$\text{- Overturning moment Z-Z} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

- Resisting about Z-Z

$$\text{- Footing weight} = 0.6 * W * L * \text{Thick} * \text{Density} = 0.6 * 3.50 * 3.50 * 8.0 / 12 * 0.15 = 0.7 \text{ kip}$$

$$\text{Arm} = L / 2 = 3.50 / 2 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.7 * 1.75 = 1.3 \text{ k-ft}$$

$$\text{- Pedestal weight} = 0.6 * W * L * H * \text{Density} = 0.6 * 6.0 / 12 * 6.0 / 12 * 0.0 * 0.15 = 0.0 \text{ kip}$$

$$\text{Arm} = L / 2 - \text{Offset} = 3.50 / 2 - 0.0 / 12 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.0 * 1.75 = 0.0 \text{ k-ft}$$

$$\text{- Soil cover} = 0.6 * W * L * SC * \text{Density} = 0.6 * (3.50 * 3.50 - 6.0 / 12 * 6.0 / 12) * 0.0 * 110 = 0.0 \text{ kip}$$

$$\text{Arm} = L / 2 = 3.50 / 2 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.0 * 1.75 = 0.0 \text{ k-ft}$$

$$\text{- Buoyancy} = 0.6 * W * L * \gamma * (SC + \text{Thick} - WT) = 0.6 * 3.50 * 3.50 * 62 * (0.67) = -0.3 \text{ kip}$$

$$\text{Arm} = L / 2 = 3.50 / 2 = 1.75 \text{ ft}$$

$$\text{Moment} = 0.3 * 1.75 = -0.5 \text{ k-ft}$$

$$\text{- Axial force } P = 0.6 * 5.2 + 0.6 * 0.0 = 3.1 \text{ kip}$$

$$\text{Arm} = L / 2 - \text{Offset} = 3.50 / 2 - 0.0 / 12 = 1.75 \text{ ft}$$

$$\text{Moment} = 3.1 * 1.75 = 5.5 \text{ k-ft}$$

$$\text{- Resisting moment Z-Z} = 1.3 + 0.0 + 0.0 + 5.5 + -0.5 = 6.2 \text{ k-ft}$$

$$\text{- Overturning safety factor Z-Z} = \frac{\text{Resisting moment}}{\text{Overturning moment}} = \frac{6.2}{0.0} = 62.11 > 1.50 \text{ OK}$$

SOIL BEARING PRESSURES (Comb: D+L)

$$\text{Overturning moment X-X} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

$$\text{Resisting moment X-X} = 2.1 + 0.0 + 0.0 + -0.9 + 31.5 = 32.8 \text{ k-ft}$$

$$\text{Overturning moment Z-Z} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

$$\text{Resisting moment Z-Z} = 2.1 + 0.0 + 0.0 + -0.9 + 31.5 = 32.8 \text{ k-ft}$$

$$\text{Resisting force} = \text{Footing} + \text{Pedestal} + \text{Soil} - \text{Buoyancy} + P = 1.2 + 0.0 + 0.0 - 0.5 + 18.0 = 18.7 \text{ kip}$$

X-coordinate of resultant from maximum bearing corner:

$$X_p = \frac{Z\text{-Resisting moment} - Z\text{-Overturning moment}}{\text{Resisting force}} = \frac{32.8 - 0.0}{18.7} = 1.75 \text{ ft}$$

Z-coordinate of resultant from maximum bearing corner:

$$Z_p = \frac{X\text{-Resisting moment} - X\text{-Overturning moment}}{\text{Resisting force}} = \frac{32.8 - 0.0}{18.7} = 1.75 \text{ ft}$$

$$X\text{-ecc} = \text{Length} / 2 - X_p = 3.50 / 2 - 1.75 = 0.00 \text{ ft}$$

$$Z\text{-ecc} = \text{Width} / 2 - Z_p = 3.50 / 2 - 1.75 = 0.00 \text{ ft}$$

$$\text{Area} = \text{Width} * \text{Length} = 3.50 * 3.50 = 12.3 \text{ ft}^2$$

$$S_x = \text{Length} * \text{Width}^2 / 6 = 3.50 * 3.50^2 / 6 = 7.1 \text{ ft}^3$$

$$S_z = \text{Width} * \text{Length}^2 / 6 = 3.50 * 3.50^2 / 6 = 7.1 \text{ ft}^3$$



- Footing is in full bearing. Soil pressures are as follows:

$$P1 = P * (1/A + Z\text{-ecc} / S_x + X\text{-ecc} / S_z) = 18.7 * (1 / 12.3 + 0.00 / 7.1 + 0.00 / 7.1) = 1.53 \text{ ksf}$$

$$P2 = P * (1/A - Z\text{-ecc} / S_x + X\text{-ecc} / S_z) = 18.7 * (1 / 12.3 - 0.00 / 7.1 + 0.00 / 7.1) = 1.53 \text{ ksf}$$

$$P3 = P * (1/A - Z\text{-ecc} / S_x - X\text{-ecc} / S_z) = 18.7 * (1 / 12.3 - 0.00 / 7.1 - 0.00 / 7.1) = 1.53 \text{ ksf}$$

$$P4 = P * (1/A + Z\text{-ecc} / S_x - X\text{-ecc} / S_z) = 18.7 * (1 / 12.3 + 0.00 / 7.1 - 0.00 / 7.1) = 1.53 \text{ ksf}$$

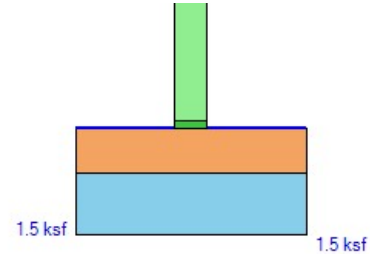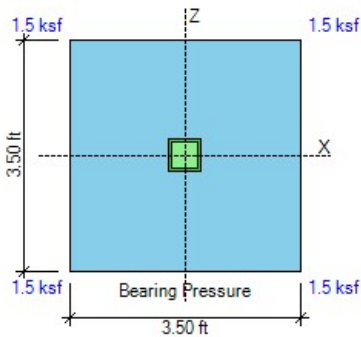

SLIDING CALCULATIONS (Comb: 0.6D+0.6W)

Internal friction angle = 28.0 deg

Passive coefficient $k_p = 4.33$ (per Coulomb)

Pressure at mid-depth = $k_p \cdot \text{Density} \cdot (\text{Cover} + \text{Thick} / 2) = 4.33 \cdot 110 \cdot (0.00 + 8.0 / 12 / 2) = 0.16$ ksf

X-Passive force = $\text{Pressure} \cdot \text{Thick} \cdot \text{Width} = 0.16 \cdot 8.0 / 12 \cdot 3.50 = 0.4$ kip

Z-Passive force = $\text{Pressure} \cdot \text{Thick} \cdot \text{Length} = 0.16 \cdot 8.0 / 12 \cdot 3.50 = 0.4$ kip

Friction force = $\text{Resisting force} \cdot \text{Friction coeff.} = \text{Max}(0, 3.5 \cdot 0.35) = 1.2$ kip

Use 100% of Passive + 100% of Friction for sliding resistance

$$\text{Sliding safety factor X-X} = \frac{\text{X-Passive force} + \text{Friction}}{\text{X-Horizontal load}} = \frac{1.00 \cdot 0.4 + 1.00 \cdot 1.2}{0.0} = 16.12 > 1.50 \text{ OK}$$

$$\text{Sliding safety factor Z-Z} = \frac{\text{Z-Passive force} + \text{Friction}}{\text{Z-Horizontal load}} = \frac{1.00 \cdot 0.4 + 1.00 \cdot 1.2}{0.0} = 16.12 > 1.50 \text{ OK}$$

UPLIFT CALCULATIONS (Comb: 0.6D+0.6W)

$$\text{Uplift safety factor} = \frac{\text{Pedestal} + \text{Footing} + \text{Cover} - \text{Buoyancy}}{\text{Uplift load}} = \frac{0.0 + 0.7 + 0.0 - 0.3}{0.0} = 99.99 > 1.00 \text{ OK}$$

ONE-WAY SHEAR CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

Concrete $f'_c = 2.5$ ksi

Steel $f_y = 40.0$ ksi

Soil density = 110 pcf

d Top X-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} / 2 = 8.0 - 2.0 - 0.8 / 2 = 5.6$ in

d Top Z-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} - \text{Z-diameter} / 2 = 8.0 - 2.0 - 0.8 - 0.8 / 2 = 4.9$ in

d Bot X-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} / 2 = 8.0 - 3.0 - 0.5 / 2 = 4.8$ in

d Bot Z-dir = $\text{Thick} - \text{Cover} - \text{X-diameter} - \text{Z-diameter} / 2 = 8.0 - 3.0 - 0.5 - 0.5 / 2 = 4.3$ in

$\phi V_{cx} = 2 \cdot \phi \cdot \sqrt{f'_c} \cdot \text{Width} \cdot d / 1000 = 2 \cdot 0.75 \cdot \sqrt{2500} \cdot 3.5 \cdot 12 \cdot 4.8 / 1000 = 15.0$ kip

ACI Eq. (22.5.5.1)

$\phi V_{cz} = 2 \cdot \phi \cdot \sqrt{f'_c} \cdot \text{Length} \cdot d / 1000 = 2 \cdot 0.75 \cdot \sqrt{2500} \cdot 3.5 \cdot 12 \cdot 4.3 / 1000 = 13.4$ kip



- Shear forces calculated as the volume of the bearing pressures under the effective areas:

One-way shear V_{ux} (- Side) = 8.6 kip < 15.0 kip OK

One-way shear V_{ux} (+ Side) = 8.6 kip < 15.0 kip OK

One-way shear V_{uz} (- Side) = 8.6 kip < 13.4 kip OK

One-way shear V_{uz} (+ Side) = 8.6 kip < 13.4 kip OK

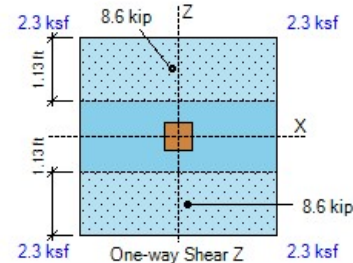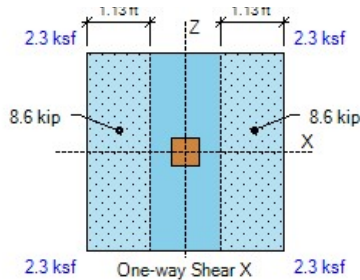

FLEXURE CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

$$\text{Plain } \phi M_{nx} = 5 * \phi * \sqrt{f_c} * L * \text{Thick}^2 / 6 = 5 * 0.60 * \sqrt{(2500)} * 3.50 * 8.0^2 / 6 / 1000 = 1.5 \text{ k-ft}$$

ACI Eq. (14.5.2.1a)

$$\text{Plain } \phi M_{nz} = 5 * \phi * \sqrt{f_c} * W * \text{Thick}^2 / 6 = 5 * 0.60 * \sqrt{(2500)} * 3.50 * 8.0^2 / 6 / 1000 = 1.5 \text{ k-ft}$$

- Top Bars

No Top Reinforcement Provided at the Footing

Use Plain Concrete Flexural Strength at Top

- Top moments calculated as the overburden minus the bearing pressures times the lever arm:

$$\text{Top moment -Mux (- Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

$$\text{Top moment -Mux (+ Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

$$\text{Top moment -Muz (- Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

$$\text{Top moment -Muz (+ Side)} = 0.0 \text{ k-ft} < 5.6 \text{ k-ft OK}$$

- Bottom Bars

$$\text{Use 5 \#4 Z-Bars } \rho = A_s / b d = 1.0 / (3.50 * 12 * 4.3) = 0.0056$$

$$q = 0.0056 * 40 / 2.5 = 0.090$$

$$\text{Use 5 \#4 X-Bars } \rho = A_s / b d = 1.0 / (3.50 * 12 * 4.8) = 0.0050$$

$$q = 0.0050 * 40 / 2.5 = 0.080$$

$$\beta = L / W = 3.50 / 3.50 = 1.00 \quad \gamma_s = 2 * \beta / (\beta + 1) = 2 * 1.00 / (1.00 + 1) = 1.00$$

ACI 13.3.3.3

$$\text{Bending strength } \phi M_n = \phi * b * d^2 * f_c * q * (1 - 0.59 * q)$$

ACI 22.2.2

$$\phi M_{nx} = 0.90 * 3.50 * 12 * 4.3^2 * 2.5 * 0.090 * (1 - 0.59 * 0.090) = 12.1 \text{ k-ft}$$

$$\phi M_{nz} = 0.90 * 3.50 * 12 * 4.8^2 * 2.5 * 0.080 / 1.00 * (1 - 0.59 * 0.080 / 1.00) = 13.6 \text{ k-ft}$$

- Bottom moments calculated as the bearing minus the overburden pressures times the lever arm:

$$\text{Bottom moment Mux (- Side)} = 8.6 \text{ k-ft} < 12.1 \text{ k-ft OK} \quad \text{ratio} = 0.71$$

$$\text{Bottom moment Mux (+ Side)} = 8.6 \text{ k-ft} < 12.1 \text{ k-ft OK} \quad \text{ratio} = 0.71$$

$$\text{Bottom moment Muz (- Side)} = 8.6 \text{ k-ft} < 13.6 \text{ k-ft OK} \quad \text{ratio} = 0.63$$

$$\text{Bottom moment Muz (+ Side)} = 8.6 \text{ k-ft} < 13.6 \text{ k-ft OK} \quad \text{ratio} = 0.63$$

$$\text{X-As min} = 0.0018 * \text{Width} * \text{Thick} = 0.0018 * 3.50 * 12 * 8.0 = 0.6 \text{ in}^2 < 1.0 \text{ in}^2 \text{ OK}$$

ACI 8.6.1.1

$$\text{Z-As min} = 0.0018 * \text{Length} * \text{Thick} = 0.0018 * 3.50 * 12 * 8.0 = 0.6 \text{ in}^2 < 1.0 \text{ in}^2 \text{ OK}$$

ACI 8.6.1.1

$$\text{X-As max for 0.005 tension strain} = 3.20 \text{ in}^2 > 1.00 \text{ in}^2 \text{ OK}$$

ACI 21.2.2

$$\text{Z-As max for 0.005 tension strain} = 3.20 \text{ in}^2 > 1.00 \text{ in}^2 \text{ OK}$$

ACI 21.2.2

$$\text{X-Cover factor} = \text{Min} (2.5, (\text{Cover} + db / 2, \text{Spacing} / 2) / db) = \text{Min} (2.5, (3.0 + 0.50 / 2, 9.0 / 2) / 0.50) = 2.5$$

$$\text{Straight } X\text{-Ld} = \text{Max} (12.0, 3 / 40 * f_y / (f_c)^{1/2} * \text{Grade} * \text{Size} * \text{Casting} / \text{Cover} * db * \text{ratio})$$

ACI Eq. (25.4.2.3a)

$$X\text{-Ld} = \text{Max} (12.0, 3 / 40 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.8 * 1.0 / 2.5 * 0.50 * 0.63) = 12.0 \text{ in}$$


$$\text{Hooked } X\text{-Ldh} = \text{Max} (8 db, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * db * \text{ratio}) =$$

ACI 25.4.3

$$X\text{-Ldh} = \text{Max} (8 db, 6, 0.02 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.50 * 0.63) = 6.0 \text{ in}$$

$$\text{-X Ld provided} = (\text{Length} - \text{Col}) / 2 + \text{Offset} - \text{Cover} = 3.50 * 12 / 2 + 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK}$$

$$\text{+X Ld provided} = (\text{Length} - \text{Col}) / 2 - \text{Offset} - \text{Cover} = 3.50 * 12 / 2 - 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK} \quad 4 \text{ of } 7$$



Pieruccioni Engineering and Construction, L

Project:

Engineer:

Descrip: Grid 10D Footing

Page # ____

8/23/2024

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

$$Z\text{-Cover factor} = \text{Min} (2.5, (\text{Cover} + db / 2, \text{Spacing} / 2) / db) = \text{Min} (2.5, (3.0 + 0.50 / 2, 9.0 / 2) / 0.50) = 2.5$$

$$\text{Straight } Z\text{-Ld} = \text{Max} (12.0, 3 / 40 * f_y / (f_c)^{1/2} * \text{Grade} * \text{Size} * \text{Casting} / \text{Cover} * db * \text{ratio})$$

ACI Eq. (25.4.2.3a)

$$Z\text{-Ld} = \text{Max} (12.0, 3 / 40 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.8 * 1.0 / 2.5 * 0.50 * 0.63) = 12.0 \text{ in}$$

$$\text{Hooked } Z\text{-Ldh} = \text{Max} (8 \text{ db}, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * db * \text{ratio}) =$$

ACI 25.4.3

$$Z\text{-Ldh} = \text{Max} (8 \text{ db}, 6, 0.02 * 40.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.50 * 0.71) = 6.0 \text{ in}$$



$$-Z \text{ Ld provided} = (\text{Width} - \text{Col}) / 2 + \text{Offset} - \text{Cover} = 3.50 * 12 / 2 + 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK}$$

$$+Z \text{ Ld provided} = (\text{Width} - \text{Col}) / 2 - \text{Offset} - \text{Cover} = 3.50 * 12 / 2 - 0.0 - 6.0 / 2 - 2.5 = 15.5 \text{ in} > 12.0 \text{ in OK}$$

$$X\text{-bar spacing} = 9.0 \text{ in} < \text{Min} (3 * t, 18.0) = 18.0 \text{ in OK}$$

ACI 7.7.2.3

$$Z\text{-bar spacing} = 9.0 \text{ in} < \text{Min} (3 * t, 18.0) = 18.0 \text{ in OK}$$

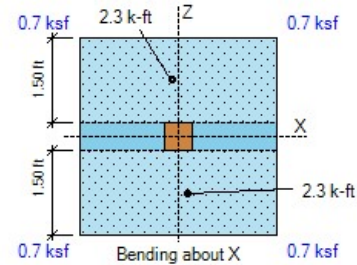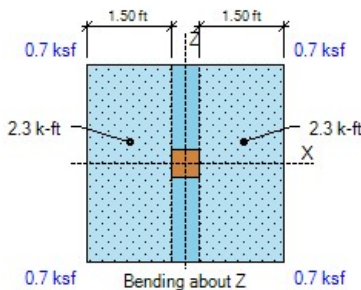

LOAD TRANSFER CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

$$\text{Area } A1 = \text{col } L * \text{col } W = 6.0 * 6.0 = 36.0 \text{ in}^2$$

$$Sx = \text{col } W * \text{col } L^2 / 6 = 6.0 * 6.0^2 / 6 = 36.0 \text{ in}^3$$

$$Sz = \text{col } L * \text{col } W^2 / 6 = 6.0 * 6.0^2 / 6 = 36.0 \text{ in}^3$$

$$\text{Bearing } Pbu = P / A1 + Mz / Sx + Mx / Sz = 26.7 / 36.0 + 0.0 * 12 / 36.0 + 0.0 * 12 / 36.0 = 0.7 \text{ ksi}$$

$$\text{Min edge} = \text{Min} (L / 2 - X\text{-offset} - \text{col } L / 2, W / 2 - Z\text{-offset} - \text{col } W / 2)$$

$$\text{Min edge} = \text{Min} (3.50 * 12 / 2 - 0.0 - 6.0 / 2, 3.50 * 12 / 2 - 0.0 - 6.0 / 2) = 18.0 \text{ in}$$

$$\text{Area } A2 = \text{Min} [L * W, (\text{col } L + 2 * \text{Min edge}) * (\text{col } W + 2 * \text{Min edge})]$$

ACI R22.8.3.2


$$A2 = \text{Min} [3.50 * 12 * 3.5 * 12, (6.0 + 2 * 18.0) * (6.0 + 2 * 18.0)] = 1764.0 \text{ in}^2$$

$$\text{Footing } \phi Pnc = \phi * 0.85 * f_c * \text{Min} [2, \sqrt{A2 / A1}] = 0.65 * 0.85 * 2.5 * \text{Min} [2, \sqrt{(1764.0 / 36.0)}] = 2.8 \text{ ksi}$$

$$\text{Footing } \phi Pns = \phi * As * Fy / A1 = 0.0 \text{ ksi}$$

ACI 22.8.3.2

$$\text{Footing bearing } \phi Pn = \phi Pnc + \phi Pns = 2.8 + 0.0 = 2.8 \text{ ksi} > 0.7 \text{ psi OK}$$



Pieruccioni Engineering and Construction, L

Project:

Page # ____

Engineer:

8/23/2024

Descrip: Grid 10D Footing

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

Hooked $L_{dh} = \text{Max} (8 \text{ db}, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * \text{db} * \text{ratio})$

ACI 25.4.3

$$L_{dh} = \text{Max} (8 \text{ db}, 6, 0.02 * 60.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.75 * 0.13) = 6.0 \text{ in}$$

Ld provided = Dowel length = $3.00 * 12 = 36.0 \text{ in} > 23.1 \text{ in OK}$

Ldh provided = Footing thickness - Cover = $8.00 - 3.0 = 5.0 \text{ in} < 6.0 \text{ in NG}$

PUNCHING SHEAR CALCULATIONS (Comb: 1.2D+1.6L+0.5Lr)

$$\text{X-Edge} = d/2 = 4.5 / 2 = 2.3 \text{ in} \quad \text{asx} = 20$$

$$\text{Z-Edge} = d/2 = 4.5 / 2 = 2.3 \text{ in} \quad \text{asz} = 20$$

$$\text{as} = \text{asx} + \text{asz} = 20 + 20 = 40 \quad \text{Col type} = \text{Interior} \quad \beta = L / W = 6.0 / 6.0 = 1.00$$

ACI 22.6.5.2

$$\text{Perimeter } b_o = \text{asx} / 10 * (L + d/2 + \text{X-Edge}) + \text{asx} / 10 * (W + d/2 + \text{Z-Edge})$$

ACI 22.6.4.2

$$b_o = 20 / 10 * (6.0 + 4.5 / 2 + 2.3) + 20 / 10 * (6.0 + 4.5 / 2 + 2.3) = 42.0 \text{ in}$$

$$\text{Area } A_{bo} = (L + d/2 + \text{X-Edge}) * (W + d/2 + \text{Z-Edge}) = (6.0 + 4.5 / 2 + 2.3) * (6.0 + 4.5 / 2 + 2.3) = 110.3 \text{ in}^2$$

$$\phi V_c = \phi * \text{Min} (2 + 4 / \beta, \text{as} * d / b_o + 2, 4) * \sqrt{f_c}$$

ACI 22.6.5.2

$$\phi V_c = 0.75 * \text{Min} (2 + 4 / 1.00, 40 * 4.5 / 42.0 + 2, 4) * \sqrt{2500} = 150.0 \text{ psi}$$

Punching force $F = P + \text{Overburden} * A_{bo} - \text{Bearing}$

$$F = 26.7 + 0.07 * 110.3 / 144 - 1.7 = 25.1 \text{ kip}$$

$$b1 = L + d/2 + \text{X-Edge} = 6.0 + 4.5 / 2 + 2.3 = 10.5 \text{ in} \quad b2 = W + d/2 + \text{Z-Edge} = 6.0 + 4.5 / 2 + 2.3 = 10.5 \text{ in}$$

$$\gamma_{vx} \text{ factor} = 1 - \frac{1}{1 + (2/3) \sqrt{b2/b1}} = 1 - \frac{1}{1 + (2/3) \sqrt{10.5/10.5}} = 0.40$$

ACI Eq. (8.4.4.2.2)

$$\gamma_{vz} \text{ factor} = 1 - \frac{1}{1 + (2/3) \sqrt{b1/b2}} = 1 - \frac{1}{1 + (2/3) \sqrt{10.5/10.5}} = 0.40$$

ACI Eq. (8.4.2.3.2)

$$X2z = b1/2 = 10.5/2 = 5.3 \text{ in} \quad X2x = b2/2 = 10.5/2 = 5.3 \text{ in}$$

$$J_{cz} = b1 * d^3 / 6 + b1^3 * d / 6 + b1^2 * b2 * d / 2$$

ACI R8.4.4.2.3

$$J_{cz} = 10.5 * 4.5^3 / 6 + 10.5^3 * 4.5 / 6 + 10.5^2 * 10.5 * 4.5 / 2 = 3632 \text{ in}^4$$

$$J_{cx} = b2 * d^3 / 6 + b2^3 * d / 6 + b2^2 * b1 * d / 2$$

ACI R8.4.4.2.3


$$J_{cx} = 10.5 * 4.5^3 / 6 + 10.5^3 * 4.5 / 6 + 10.5^2 * 10.5 * 4.5 / 2 = 3632 \text{ in}^4$$


$$\text{Stress due to } P = F / (b_o * d) * 1000 = 25.1 / (42.0 * 4.5) * 1000 = 132.5 \text{ psi}$$

$$\text{Stress due to } M_x = \gamma_{vx} * X\text{-OTM} * X2x / J_{cx} = 0.40 * 0.0 * 12 * 5.3 / 3632 * 1000 = 0.0 \text{ psi}$$

$$\text{Stress due to } M_z = \gamma_{vz} * Z\text{-OTM} * X2z / J_{cz} = 0.40 * 0.0 * 12 * 5.3 / 3632 * 1000 = 0.0 \text{ psi}$$

$$\text{Punching stress} = P\text{-stress} + M_x\text{-stress} + M_z\text{-stress} = 132.5 + 0.0 + 0.0 = 132.5 \text{ psi} < 150.0 \text{ psi OK}$$

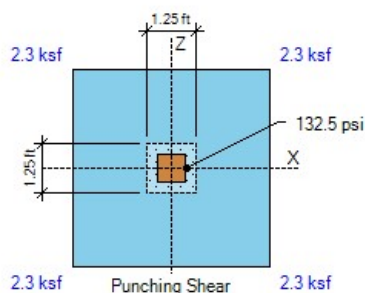



Pieruccioni Engineering and Construction, L

Project:

Engineer:

Descrip: Grid 10D Footing

Page # ____

8/23/2024

ASDIP Foundation 5.3.0.0


SPREAD FOOTING DESIGN


www.asdipsoft.com

DESIGN CODES

Concrete Design ACI 318-14

Load Combinations ASCE 7-10/16

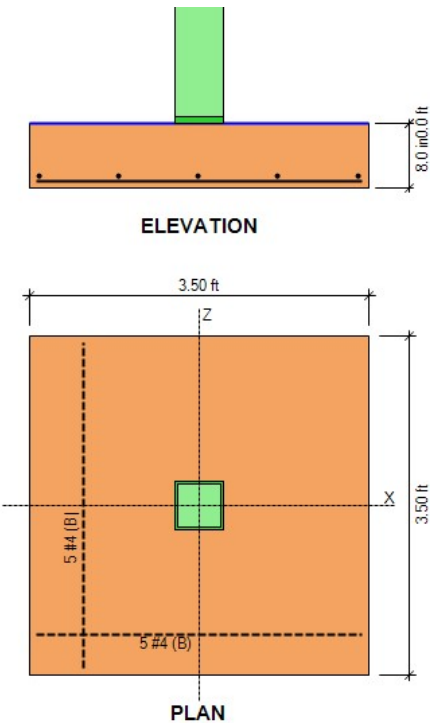



Pieruccioni Engineering and Construction, L

Project:

Page # _____

Engineer:

8/23/2024

Descrip: Typical exterior Footing 6,000# point load

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

GEOMETRY

| | | | |
|------------------------------|-----------|----|----|
| Footing Length (X-dir) | 2.00 | ft | |
| Footing Width (Z-dir) | 2.60 | ft | |
| Footing Thickness | 8.0 | in | OK |
| Soil Cover | 0.00 | ft | |
| Column Length (X-dir) | 6.0 | in | |
| Column Width (Z-dir) | 6.0 | in | |
| Offset (X-dir) | 0.00 | in | OK |
| Offset (Z-dir) | 0.00 | in | OK |
| Base Plate (L x W) | 6.0 x 6.0 | in | |

SOIL PRESSURES (D+L)

| | | | |
|--------------------------------------|-------|-----|----|
| Gross Allow. Soil Pressure | 2.0 | ksf | |
| Soil Pressure at Corner 1 | 2.0 | ksf | |
| Soil Pressure at Corner 2 | 2.0 | ksf | |
| Soil Pressure at Corner 3 | 2.0 | ksf | |
| Soil Pressure at Corner 4 | 2.0 | ksf | |
| Bearing Pressure Ratio | 0.99 | | OK |
| Ftg. Area in Contact with Soil | 100.0 | % | |
| X-eccentricity / Ftg. Length | 0.00 | | OK |
| Z-eccentricity / Ftg. Width | 0.00 | | OK |

APPLIED LOADS

| | Dead | Live | RLive | Snow | Wind | Seismic | |
|----------------------|------|------|-------|------|------|---------|------|
| Axial Force P | 4.5 | 5.5 | 0.0 | 0.0 | 0.0 | 0.0 | kip |
| Moment about X Mx .. | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | k-ft |
| Moment about Z Mz .. | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | k-ft |
| Shear Force Vx | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | kip |
| Shear Force Vz | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | kip |

OVERTURNING CALCULATIONS (Comb: 0.6D+0.6W)

- Overturning about X-X

- Moment Mx = $0.6 * 0.0 + 0.6 * 0.0 = 0.0$ k-ft

- Shear Force Vz = $0.6 * 0.0 + 0.6 * 0.0 = 0.0$ kip

Arm = $0.00 + 8.0 / 12 = 0.67$ ft

Moment = $0.0 * 0.67 = 0.0$ k-ft

- Passive Force = 0.0 kip

Arm = 0.27 ft

Moment = 0.0 k-ft

- Overturning moment X-X = $0.0 + 0.0 = 0.0$ k-ft

- Resisting about X-X

- Footing weight = $0.6 * W * L * Thick * Density = 0.6 * 2.60 * 2.00 * 8.0 / 12 * 0.15 = 0.3$ kip

Arm = $W / 2 = 2.60 / 2 = 1.30$ ft

Moment = $0.3 * 1.30 = 0.4$ k-ft

- Pedestal weight = $0.6 * W * L * H * Density = 0.6 * 6.0 / 12 * 6.0 / 12 * 0.0 * 0.15 = 0.0$ kip

Arm = $W / 2 - Offset = 2.60 / 2 - 0.0 / 12 = 1.30$ ft

Moment = $0.0 * 1.30 = 0.0$ k-ft

- Soil cover = $0.6 * W * L * SC * Density = 0.6 * (2.60 * 2.00 - 6.0 / 12 * 6.0 / 12) * 0.0 * 110 = 0.0$ kip

Arm = $W / 2 = 2.60 / 2 = 1.30$ ft

Moment = $0.0 * 1.30 = 0.0$ k-ft

- Buoyancy = $0.6 * W * L * \gamma * (SC + Thick - WT) = 0.6 * 2.60 * 2.00 * 62 * (0.67) = -0.1$ kip

Arm = $W / 2 = 2.60 / 2 = 1.30$ ft

Moment = $0.1 * 1.30 = -0.2$ k-ft


- Axial force P = $0.6 * 4.5 + 0.6 * 0.0 = 2.7$ kip

Arm = $W / 2 - Offset = 2.60 / 2 - 0.0 / 12 = 1.30$ ft

Moment = $2.7 * 1.30 = 3.5$ k-ft

- Resisting moment X-X = $0.4 + 0.0 + 0.0 + 3.5 + -0.2 = 3.7$ k-ft

- Overturning safety factor X-X = $\frac{\text{Resisting moment}}{\text{Overturning moment}} = \frac{3.7}{0.0} = 37.47 > 1.50$ OK



Pieruccioni Engineering and Construction, L

Project:

Page # ____

Engineer:

8/23/2024

Descrip: Typical exterior Footing 6,000# point load

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

- Overturning about Z-Z

$$\text{- Moment } M_z = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 \text{ k-ft}$$

$$\text{- Shear Force } V_x = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 \text{ kip}$$

$$\text{Arm} = 0.00 + 8.0 / 12 = 0.67 \text{ ft}$$

$$\text{Moment} = 0.0 * 0.67 = 0.0 \text{ k-ft}$$

$$\text{- Passive Force} = 0.0 \text{ kip}$$

$$\text{Arm} = 0.27 \text{ ft}$$

$$\text{Moment} = 0.0 \text{ k-ft}$$

$$\text{- Overturning moment } Z-Z = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

- Resisting about Z-Z

$$\text{- Footing weight} = 0.6 * W * L * Thick * Density = 0.6 * 2.60 * 2.00 * 8.0 / 12 * 0.15 = 0.3 \text{ kip}$$

$$\text{Arm} = L / 2 = 2.00 / 2 = 1.00 \text{ ft}$$

$$\text{Moment} = 0.3 * 1.00 = 0.3 \text{ k-ft}$$

$$\text{- Pedestal weight} = 0.6 * W * L * H * Density = 0.6 * 6.0 / 12 * 6.0 / 12 * 0.0 * 0.15 = 0.0 \text{ kip}$$

$$\text{Arm} = L / 2 - Offset = 2.00 / 2 - 0.0 / 12 = 1.00 \text{ ft}$$

$$\text{Moment} = 0.0 * 1.00 = 0.0 \text{ k-ft}$$

$$\text{- Soil cover} = 0.6 * W * L * SC * Density = 0.6 * (2.60 * 2.00 - 6.0 / 12 * 6.0 / 12) * 0.0 * 110 = 0.0 \text{ kip}$$

$$\text{Arm} = L / 2 = 2.00 / 2 = 1.00 \text{ ft}$$

$$\text{Moment} = 0.0 * 1.00 = 0.0 \text{ k-ft}$$

$$\text{- Buoyancy} = 0.6 * W * L * \gamma * (SC + Thick - WT) = 0.6 * 2.60 * 2.00 * 62 * (0.67) = -0.1 \text{ kip}$$

$$\text{Arm} = L / 2 = 2.00 / 2 = 1.00 \text{ ft}$$

$$\text{Moment} = 0.1 * 1.00 = -0.1 \text{ k-ft}$$

$$\text{- Axial force } P = 0.6 * 4.5 + 0.6 * 0.0 = 2.7 \text{ kip}$$

$$\text{Arm} = L / 2 - Offset = 2.00 / 2 - 0.0 / 12 = 1.00 \text{ ft}$$

$$\text{Moment} = 2.7 * 1.00 = 2.7 \text{ k-ft}$$

$$\text{- Resisting moment } Z-Z = 0.3 + 0.0 + 0.0 + 2.7 + -0.1 = 2.9 \text{ k-ft}$$

$$\text{- Overturning safety factor } Z-Z = \frac{\text{Resisting moment}}{\text{Overturning moment}} = \frac{2.9}{0.0} = 28.82 > 1.50 \text{ OK}$$

SOIL BEARING PRESSURES (Comb: D+L)

$$\text{Overturning moment } X-X = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

$$\text{Resisting moment } X-X = 0.7 + 0.0 + 0.0 + -0.3 + 13.0 = 13.4 \text{ k-ft}$$

$$\text{Overturning moment } Z-Z = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

$$\text{Resisting moment } Z-Z = 0.5 + 0.0 + 0.0 + -0.2 + 10.0 = 10.3 \text{ k-ft}$$

$$\text{Resisting force} = \text{Footing} + \text{Pedestal} + \text{Soil} - \text{Buoyancy} + P = 0.5 + 0.0 + 0.0 - 0.2 + 10.0 = 10.3 \text{ kip}$$

X-coordinate of resultant from maximum bearing corner:

$$X_p = \frac{Z\text{-Resisting moment} - Z\text{-Overturning moment}}{\text{Resisting force}} = \frac{10.3 - 0.0}{10.3} = 1.00 \text{ ft}$$

Z-coordinate of resultant from maximum bearing corner:

$$Z_p = \frac{X\text{-Resisting moment} - X\text{-Overturning moment}}{\text{Resisting force}} = \frac{13.4 - 0.0}{10.3} = 1.30 \text{ ft}$$

$$X\text{-ecc} = \text{Length} / 2 - X_p = 2.00 / 2 - 1.00 = 0.00 \text{ ft}$$

$$Z\text{-ecc} = \text{Width} / 2 - Z_p = 2.60 / 2 - 1.30 = 0.00 \text{ ft}$$

$$\text{Area} = \text{Width} * \text{Length} = 2.60 * 2.00 = 5.2 \text{ ft}^2$$

$$S_x = \text{Length} * \text{Width}^2 / 6 = 2.00 * 2.60^2 / 6 = 2.3 \text{ ft}^3$$

$$S_z = \text{Width} * \text{Length}^2 / 6 = 2.60 * 2.00^2 / 6 = 1.7 \text{ ft}^3$$



- Footing is in full bearing. Soil pressures are as follows:

$$P1 = P * (1/A + Z\text{-ecc} / S_x + X\text{-ecc} / S_z) = 10.3 * (1/5.2 + 0.00 / 2.3 + 0.00 / 1.7) = 1.98 \text{ ksf}$$

$$P2 = P * (1/A - Z\text{-ecc} / S_x + X\text{-ecc} / S_z) = 10.3 * (1/5.2 - 0.00 / 2.3 + 0.00 / 1.7) = 1.98 \text{ ksf}$$

$$P3 = P * (1/A - Z\text{-ecc} / S_x - X\text{-ecc} / S_z) = 10.3 * (1/5.2 - 0.00 / 2.3 - 0.00 / 1.7) = 1.98 \text{ ksf}$$

$$P4 = P * (1/A + Z\text{-ecc} / S_x - X\text{-ecc} / S_z) = 10.3 * (1/5.2 + 0.00 / 2.3 - 0.00 / 1.7) = 1.98 \text{ ksf}$$

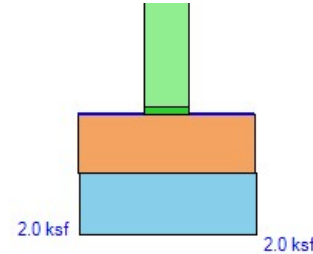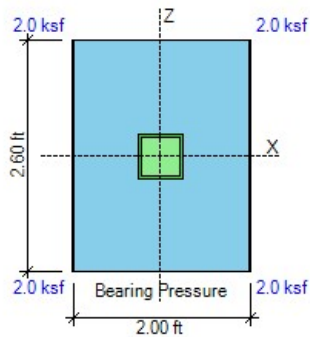

SLIDING CALCULATIONS (Comb: 0.6D+0.6W)

Internal friction angle = 28.0 deg

Passive coefficient $k_p = 4.33$ (per Coulomb)

Pressure at mid-depth = $k_p \cdot \text{Density} \cdot (\text{Cover} + \text{Thick} / 2) = 4.33 \cdot 110 \cdot (0.00 + 8.0 / 12 / 2) = 0.16$ ksf

X-Passive force = $\text{Pressure} \cdot \text{Thick} \cdot \text{Width} = 0.16 \cdot 8.0 / 12 \cdot 2.60 = 0.3$ kip

Z-Passive force = $\text{Pressure} \cdot \text{Thick} \cdot \text{Length} = 0.16 \cdot 8.0 / 12 \cdot 2.00 = 0.2$ kip

Friction force = $\text{Resisting force} \cdot \text{Friction coeff.} = \text{Max}(0, 2.9 \cdot 0.35) = 1.0$ kip

Use 100% of Passive + 100% of Friction for sliding resistance

$$\text{- Sliding safety factor X-X} = \frac{\text{X-Passive force} + \text{Friction}}{\text{X-Horizontal load}} = \frac{1.00 \cdot 0.3 + 1.00 \cdot 1.0}{0.0} = 12.84 > 1.50 \text{ OK}$$

$$\text{- Sliding safety factor Z-Z} = \frac{\text{Z-Passive force} + \text{Friction}}{\text{Z-Horizontal load}} = \frac{1.00 \cdot 0.2 + 1.00 \cdot 1.0}{0.0} = 12.20 > 1.50 \text{ OK}$$

UPLIFT CALCULATIONS (Comb: 0.6D+0.6W)

$$\text{- Uplift safety factor} = \frac{\text{Pedestal} + \text{Footing} + \text{Cover} - \text{Buoyancy}}{\text{Uplift load}} = \frac{0.0 + 0.3 + 0.0 - 0.1}{0.0} = 99.99 > 1.00 \text{ OK}$$

ONE-WAY SHEAR CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

Concrete $f'_c = 2.5$ ksi

Steel $f_y = 40.0$ ksi

Soil density = 110 pcf

Use Plain Concrete Shear Strength

$$\phi V_{cx} = \frac{4}{3} \cdot \phi \cdot \sqrt{f'_c} \cdot \text{Width} \cdot t / 1000 = \frac{4}{3} \cdot 0.60 \cdot \sqrt{2500} \cdot 2.6 \cdot 12 \cdot 8.0 / 1000 = 10.0 \text{ kip}$$

ACI 14.5.5.1

$$\phi V_{cz} = \frac{4}{3} \cdot \phi \cdot \sqrt{f'_c} \cdot \text{Length} \cdot t / 1000 = \frac{4}{3} \cdot 0.60 \cdot \sqrt{2500} \cdot 2.0 \cdot 12 \cdot 8.0 / 1000 = 7.7 \text{ kip}$$



- Shear forces calculated as the volume of the bearing pressures under the effective areas:

$$\text{One-way shear } V_{ux} \text{ (- Side)} = 0.6 \text{ kip} < 10.0 \text{ kip OK}$$

$$\text{One-way shear } V_{ux} \text{ (+ Side)} = 0.6 \text{ kip} < 10.0 \text{ kip OK}$$

$$\text{One-way shear } V_{uz} \text{ (- Side)} = 2.1 \text{ kip} < 7.7 \text{ kip OK}$$

$$\text{One-way shear } V_{uz} \text{ (+ Side)} = 2.1 \text{ kip} < 7.7 \text{ kip OK}$$

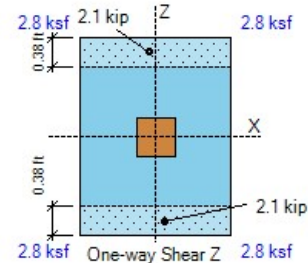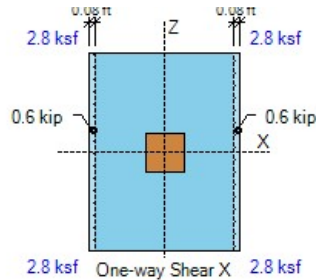

FLEXURE CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

Plain $\phi M_{nx} = 5 * \phi * \sqrt{f_c} * L * Thick^2 / 6 = 5 * 0.60 * \sqrt{(2500)} * 2.00 * 8.0^2 / 6 / 1000 = 0.9 \text{ k-ft}$

ACI Eq. (14.5.2.1a)

Plain $\phi M_{nz} = 5 * \phi * \sqrt{f_c} * W * Thick^2 / 6 = 5 * 0.60 * \sqrt{(2500)} * 2.60 * 8.0^2 / 6 / 1000 = 1.1 \text{ k-ft}$

- Top Bars

No Top Reinforcement Provided at the Footing

Use Plain Concrete Flexural Strength at Top

- Top moments calculated as the overburden minus the bearing pressures times the lever arm:

Top moment -Mux (- Side) = 0.0 k-ft < 3.2 k-ft OK

Top moment -Mux (+ Side) = 0.0 k-ft < 3.2 k-ft OK

Top moment -Muz (- Side) = 0.0 k-ft < 4.2 k-ft OK

Top moment -Muz (+ Side) = 0.0 k-ft < 4.2 k-ft OK

- Bottom Bars

No Bottom Reinforcement Provided at the Footing

Use Plain Concrete Flexural Strength at Bottom



- Bottom moments calculated as the bearing minus the overburden pressures times the lever arm:


Bottom moment Mux (- Side) = 3.0 k-ft < 3.2 k-ft OK ratio = 0.94

Bottom moment Mux (+ Side) = 3.0 k-ft < 3.2 k-ft OK ratio = 0.94

Bottom moment Muz (- Side) = 2.0 k-ft < 4.2 k-ft OK ratio = 0.48

Bottom moment Muz (+ Side) = 2.0 k-ft < 4.2 k-ft OK ratio = 0.48

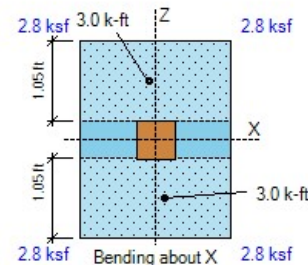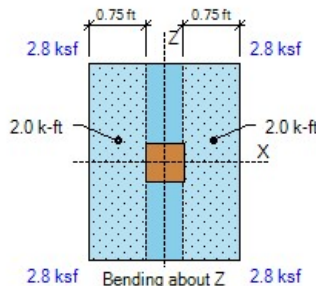



Pieruccioni Engineering and Construction, L

Project:

Page # ____

Engineer:

8/23/2024

Descrip: Typical exterior Footing 6,000# point load

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

LOAD TRANSFER CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

$$\text{Area } A1 = \text{col } L * \text{col } W = 6.0 * 6.0 = 36.0 \text{ in}^2$$

$$Sx = \text{col } W * \text{col } L^2 / 6 = 6.0 * 6.0^2 / 6 = 36.0 \text{ in}^3$$

$$Sz = \text{col } L * \text{col } W^2 / 6 = 6.0 * 6.0^2 / 6 = 36.0 \text{ in}^3$$

$$\text{Bearing } Pbu = P / A1 + Mz / Sx + Mx / Sz = 14.2 / 36.0 + 0.0 * 12 / 36.0 + 0.0 * 12 / 36.0 = 0.4 \text{ ksi}$$

$$\text{Min edge} = \text{Min} (L / 2 - X\text{-offset} - \text{col } L / 2, W / 2 - Z\text{-offset} - \text{col } W / 2)$$

$$\text{Min edge} = \text{Min} (2.00 * 12 / 2 - 0.0 - 6.0 / 2, 2.60 * 12 / 2 - 0.0 - 6.0 / 2) = 9.0 \text{ in}$$

$$\text{Area } A2 = \text{Min} [L * W, (\text{col } L + 2 * \text{Min edge}) * (\text{col } W + 2 * \text{Min edge})]$$

ACI R22.8.3.2

$$A2 = \text{Min} [2.00 * 12 * 2.6 * 12, (6.0 + 2 * 9.0) * (6.0 + 2 * 9.0)] = 576.0 \text{ in}^2$$

$$\text{Footing } \phi Pnc = \phi * 0.85 * f'c * \text{Min} [2, \sqrt{(A2 / A1)}] = 0.65 * 0.85 * 2.5 * \text{Min} [2, \sqrt{(576.0 / 36.0)}] = 2.8 \text{ ksi}$$

$$\text{Footing } \phi Pns = \phi * As * Fy / A1 = 0.0 \text{ ksi}$$

ACI 22.8.3.2

$$\text{Footing bearing } \phi Pn = \phi Pnc + \phi Pns = 2.8 + 0.0 = 2.8 \text{ ksi} > 0.4 \text{ psi OK}$$

Hooked $L_{dh} = \text{Max} (8 \text{ db}, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * \text{db} * \text{ratio})$

ACI 25.4.3

$$L_{dh} = \text{Max} (8 \text{ db}, 6, 0.02 * 60.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.75 * 0.07) = 6.0 \text{ in}$$

Ld provided = Dowel length = $3.00 * 12 = 36.0 \text{ in} > 12.3 \text{ in OK}$

Ldh provided = Footing thickness - Cover = $8.00 - 3.0 = 5.0 \text{ in} < 6.0 \text{ in NG}$

PUNCHING SHEAR CALCULATIONS (Comb: 1.2D+1.6L+0.5Lr)

$$\text{X-Edge} = \text{Length} / 2 - \text{Offset} - \text{Col} / 2 = 2.00 * 12 / 2 - 0.0 - 6.0 / 2 = 9.0 \text{ in} \quad \alpha_{sx} = 10$$

$$\text{Z-Edge} = \text{Width} / 2 - \text{Offset} - \text{Col} / 2 = 2.60 * 12 / 2 - 0.0 - 6.0 / 2 = 12.6 \text{ in} \quad \alpha_{sz} = 10$$

$$\alpha_s = \alpha_{sx} + \alpha_{sz} = 10 + 10 = 20 \quad \text{Col type} = \text{Corner} \quad \beta = L / W = 6.0 / 6.0 = 1.00$$

ACI 22.6.5.2

$$\text{Perimeter } b_o = \alpha_{sz} / 10 * (L + d / 2 + \text{X-Edge}) + \alpha_{sx} / 10 * (W + d / 2 + \text{Z-Edge})$$

ACI 22.6.4.2

$$b_o = 10 / 10 * (6.0 + 8.0 / 2 + 9.0) + 10 / 10 * (6.0 + 8.0 / 2 + 12.6) = 41.6 \text{ in}$$

$$\text{Area } A_{bo} = (L + d / 2 + \text{X-Edge}) * (W + d / 2 + \text{Z-Edge}) = (6.0 + 8.0 / 2 + 9.0) * (6.0 + 8.0 / 2 + 12.6) = 429.4 \text{ in}^2$$

Use Plain Concrete Shear Strength

$$\phi V_c = \phi * \text{Min} (1 + 2 / \beta, 2) * 4/3 * \sqrt{f_c}$$

ACI 14.5.5.1

$$\phi V_c = 0.60 * \text{Min} (1 + 2 / 1.00, 2) * 4/3 * \sqrt{2500} = 80.0 \text{ psi}$$

Punching force $F = P + \text{Overburden} * A_{bo} - \text{Bearing}$

$$F = 14.2 + 0.07 * 429.4 / 144 - 3.8 = 10.6 \text{ kip}$$

$$b_1 = L + d / 2 + \text{X-Edge} = 6.0 + 8.0 / 2 + 9.0 = 19.0 \text{ in} \quad b_2 = W + d / 2 + \text{Z-Edge} = 6.0 + 8.0 / 2 + 12.6 = 22.6 \text{ in}$$

$$\gamma_{vx} \text{ factor} = 1 - \frac{1}{1 + (2/3) \sqrt{b_2 / b_1}} = 1 - \frac{1}{1 + (2/3) \sqrt{22.6 / 19.0}} = 0.42$$

ACI Eq. (8.4.4.2.2)

$$\gamma_{vz} \text{ factor} = 1 - \frac{1}{1 + (2/3) \sqrt{b_1 / b_2}} = 1 - \frac{1}{1 + (2/3) \sqrt{19.0 / 22.6}} = 0.38$$

ACI Eq. (8.4.2.3.2)

$$X_{2z} = b_1^2 / 2 / (b_1 + b_2) = 19.0^2 / 2 / (19.0 + 22.6) = 4.3 \text{ in} \quad X_{2x} = b_2^2 / 2 / (b_2 + b_1) = 6.1 \text{ in}$$

$$J_{cz} = b_1 * d^3 / 12 + b_1^3 * d / 12 + b_1 * d * (b_1 / 2 - X_{2z})^2 + b_2 * d * X_{2z}^2$$

ACI R8.4.4.2.3

$$J_{cz} = 19.0 * 8.0^3 / 12 + 19.0^3 * 8.0 / 12 + 19.0 * 8.0 * (19.0 / 2 - 4.3)^2 + 22.6 * 8.0 * 4.3^2 = 12836 \text{ in}^4$$

$$J_{cx} = b_2 * d^3 / 12 + b_2^3 * d / 12 + b_2 * d * (b_2 / 2 - X_{2x})^2 + b_1 * d * X_{2x}^2$$

ACI R8.4.4.2.3


$$J_{cx} = 22.6 * 8.0^3 / 12 + 22.6^3 * 8.0 / 12 + 22.6 * 8.0 * (22.6 / 2 - 6.1)^2 + 19.0 * 8.0 * 6.1^2 = 19204 \text{ in}^4$$


$$\text{Stress due to } P = F / (b_o * d) * 1000 = 10.6 / (41.6 * 8.0) * 1000 = 31.8 \text{ psi}$$

$$\text{Stress due to } M_x = \gamma_{vx} * X\text{-OTM} * X_{2x} / J_{cx} = 0.42 * 0.0 * 12 * 6.1 / 19204 * 1000 = 0.0 \text{ psi}$$

$$\text{Stress due to } M_z = \gamma_{vz} * Z\text{-OTM} * X_{2z} / J_{cz} = 0.42 * 0.0 * 12 * 4.3 / 12836 * 1000 = 0.0 \text{ psi}$$

$$\text{Punching stress} = P\text{-stress} + M_x\text{-stress} + M_z\text{-stress} = 31.8 + 0.0 + 0.0 = 31.8 \text{ psi} < 80.0 \text{ psi OK}$$

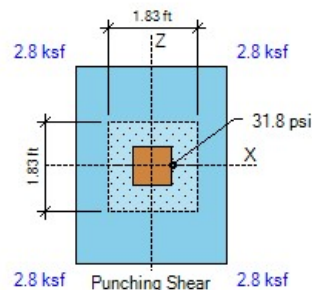



Pieruccioni Engineering and Construction, L


Project: _____
Engineer: _____
Descrip: Typical exterior Footing 6,000# point load


Page # _____
8/23/2024

ASDIP Foundation 5.3.0.0 SPREAD FOOTING DESIGN www.asdipsoft.com

DESIGN CODES

Concrete Design ACI 318-14
Load Combinations ASCE 7-10/16

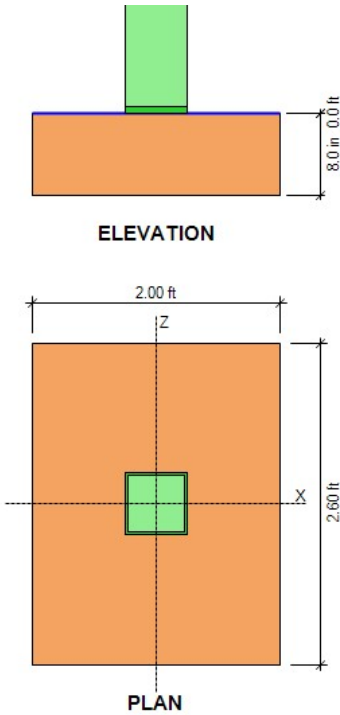



Pieruccioni Engineering and Construction, L

Project:

Page # _____

Engineer:

8/23/2024

Descrip: Typical Interior Footing 6,500# point load

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

GEOMETRY

| | | | |
|------------------------------|-----------|----|----|
| Footing Length (X-dir) | 1.50 | ft | |
| Footing Width (Z-dir) | 2.60 | ft | |
| Footing Thickness | 8.0 | in | OK |
| Soil Cover | 0.00 | ft | |
| Column Length (X-dir) | 6.0 | in | |
| Column Width (Z-dir) | 6.0 | in | |
| Offset (X-dir) | 0.00 | in | OK |
| Offset (Z-dir) | 0.00 | in | OK |
| Base Plate (L x W) | 6.0 x 6.0 | in | |

SOIL PRESSURES (D+L)

| | | | |
|--------------------------------------|-------|-----|----|
| Gross Allow. Soil Pressure | 2.0 | ksf | |
| Soil Pressure at Corner 1 | 2.0 | ksf | |
| Soil Pressure at Corner 2 | 2.0 | ksf | |
| Soil Pressure at Corner 3 | 2.0 | ksf | |
| Soil Pressure at Corner 4 | 2.0 | ksf | |
| Bearing Pressure Ratio | 0.99 | | OK |
| Ftg. Area in Contact with Soil | 100.0 | % | |
| X-eccentricity / Ftg. Length | 0.00 | | OK |
| Z-eccentricity / Ftg. Width | 0.00 | | OK |

APPLIED LOADS

| | Dead | Live | RLive | Snow | Wind | Seismic | |
|----------------------|------|------|-------|------|------|---------|------|
| Axial Force P | 3.0 | 4.5 | 0.0 | 0.0 | 0.0 | 0.0 | kip |
| Moment about X Mx .. | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | k-ft |
| Moment about Z Mz .. | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | k-ft |
| Shear Force Vx | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | kip |
| Shear Force Vz | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | kip |

OVERTURNING CALCULATIONS (Comb: 0.6D+0.6W)

- Overturning about X-X

- Moment Mx = $0.6 * 0.0 + 0.6 * 0.0 = 0.0$ k-ft

- Shear Force Vz = $0.6 * 0.0 + 0.6 * 0.0 = 0.0$ kip

Arm = $0.00 + 8.0 / 12 = 0.67$ ft

Moment = $0.0 * 0.67 = 0.0$ k-ft

- Passive Force = 0.0 kip

Arm = 0.27 ft

Moment = 0.0 k-ft

- Overturning moment X-X = $0.0 + 0.0 = 0.0$ k-ft

- Resisting about X-X

- Footing weight = $0.6 * W * L * Thick * Density = 0.6 * 2.60 * 1.50 * 8.0 / 12 * 0.15 = 0.2$ kip

Arm = $W / 2 = 2.60 / 2 = 1.30$ ft

Moment = $0.2 * 1.30 = 0.3$ k-ft

- Pedestal weight = $0.6 * W * L * H * Density = 0.6 * 6.0 / 12 * 6.0 / 12 * 0.0 * 0.15 = 0.0$ kip

Arm = $W / 2 - Offset = 2.60 / 2 - 0.0 / 12 = 1.30$ ft

Moment = $0.0 * 1.30 = 0.0$ k-ft

- Soil cover = $0.6 * W * L * SC * Density = 0.6 * (2.60 * 1.50 - 6.0 / 12 * 6.0 / 12) * 0.0 * 110 = 0.0$ kip

Arm = $W / 2 = 2.60 / 2 = 1.30$ ft

Moment = $0.0 * 1.30 = 0.0$ k-ft

- Buoyancy = $0.6 * W * L * \gamma * (SC + Thick - WT) = 0.6 * 2.60 * 1.50 * 62 * (0.67) = -0.1$ kip

Arm = $W / 2 = 2.60 / 2 = 1.30$ ft

Moment = $0.1 * 1.30 = -0.1$ k-ft


- Axial force P = $0.6 * 3.0 + 0.6 * 0.0 = 1.8$ kip

Arm = $W / 2 - Offset = 2.60 / 2 - 0.0 / 12 = 1.30$ ft

Moment = $1.8 * 1.30 = 2.3$ k-ft

- Resisting moment X-X = $0.3 + 0.0 + 0.0 + 2.3 + -0.1 = 2.5$ k-ft

- Overturning safety factor X-X = $\frac{\text{Resisting moment}}{\text{Overturning moment}} = \frac{2.5}{0.0} = 25.18 > 1.50$ OK



Pieruccioni Engineering and Construction, L

Project:

Page # ____

Engineer:

8/23/2024

Descrip: Typical Interior Footing 6,500# point load

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

- Overturning about Z-Z

$$\text{- Moment } M_z = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 \text{ k-ft}$$

$$\text{- Shear Force } V_x = 0.6 * 0.0 + 0.6 * 0.0 = 0.0 \text{ kip}$$

$$\text{Arm} = 0.00 + 8.0 / 12 = 0.67 \text{ ft}$$

$$\text{Moment} = 0.0 * 0.67 = 0.0 \text{ k-ft}$$

$$\text{- Passive Force} = 0.0 \text{ kip}$$

$$\text{Arm} = 0.27 \text{ ft}$$

$$\text{Moment} = 0.0 \text{ k-ft}$$

$$\text{- Overturning moment Z-Z} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

- Resisting about Z-Z

$$\text{- Footing weight} = 0.6 * W * L * Thick * Density = 0.6 * 2.60 * 1.50 * 8.0 / 12 * 0.15 = 0.2 \text{ kip}$$

$$\text{Arm} = L / 2 = 1.50 / 2 = 0.75 \text{ ft}$$

$$\text{Moment} = 0.2 * 0.75 = 0.2 \text{ k-ft}$$

$$\text{- Pedestal weight} = 0.6 * W * L * H * Density = 0.6 * 6.0 / 12 * 6.0 / 12 * 0.0 * 0.15 = 0.0 \text{ kip}$$

$$\text{Arm} = L / 2 - Offset = 1.50 / 2 - 0.0 / 12 = 0.75 \text{ ft}$$

$$\text{Moment} = 0.0 * 0.75 = 0.0 \text{ k-ft}$$

$$\text{- Soil cover} = 0.6 * W * L * SC * Density = 0.6 * (2.60 * 1.50 - 6.0 / 12 * 6.0 / 12) * 0.0 * 110 = 0.0 \text{ kip}$$

$$\text{Arm} = L / 2 = 1.50 / 2 = 0.75 \text{ ft}$$

$$\text{Moment} = 0.0 * 0.75 = 0.0 \text{ k-ft}$$

$$\text{- Buoyancy} = 0.6 * W * L * \gamma * (SC + Thick - WT) = 0.6 * 2.60 * 1.50 * 62 * (0.67) = -0.1 \text{ kip}$$

$$\text{Arm} = L / 2 = 1.50 / 2 = 0.75 \text{ ft}$$

$$\text{Moment} = 0.1 * 0.75 = -0.1 \text{ k-ft}$$

$$\text{- Axial force } P = 0.6 * 3.0 + 0.6 * 0.0 = 1.8 \text{ kip}$$

$$\text{Arm} = L / 2 - Offset = 1.50 / 2 - 0.0 / 12 = 0.75 \text{ ft}$$

$$\text{Moment} = 1.8 * 0.75 = 1.4 \text{ k-ft}$$

$$\text{- Resisting moment Z-Z} = 0.2 + 0.0 + 0.0 + 1.4 + -0.1 = 1.5 \text{ k-ft}$$

$$\text{- Overturning safety factor Z-Z} = \frac{\text{Resisting moment}}{\text{Overturning moment}} = \frac{1.5}{0.0} = 14.52 > 1.50 \text{ OK}$$

SOIL BEARING PRESSURES (Comb: D+L)

$$\text{Overturning moment X-X} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

$$\text{Resisting moment X-X} = 0.5 + 0.0 + 0.0 + -0.2 + 9.8 = 10.0 \text{ k-ft}$$

$$\text{Overturning moment Z-Z} = 0.0 + 0.0 = 0.0 \text{ k-ft}$$

$$\text{Resisting moment Z-Z} = 0.3 + 0.0 + 0.0 + -0.1 + 5.6 = 5.8 \text{ k-ft}$$

$$\text{Resisting force} = \text{Footing} + \text{Pedestal} + \text{Soil} - \text{Buoyancy} + P = 0.4 + 0.0 + 0.0 - 0.2 + 7.5 = 7.7 \text{ kip}$$

X-coordinate of resultant from maximum bearing corner:

$$X_p = \frac{Z\text{-Resisting moment} - Z\text{-Overturning moment}}{\text{Resisting force}} = \frac{5.8 - 0.0}{7.7} = 0.75 \text{ ft}$$

Z-coordinate of resultant from maximum bearing corner:

$$Z_p = \frac{X\text{-Resisting moment} - X\text{-Overturning moment}}{\text{Resisting force}} = \frac{10.0 - 0.0}{7.7} = 1.30 \text{ ft}$$

$$X\text{-ecc} = \text{Length} / 2 - X_p = 1.50 / 2 - 0.75 = 0.00 \text{ ft}$$

$$Z\text{-ecc} = \text{Width} / 2 - Z_p = 2.60 / 2 - 1.30 = 0.00 \text{ ft}$$

$$\text{Area} = \text{Width} * \text{Length} = 2.60 * 1.50 = 3.9 \text{ ft}^2$$

$$S_x = \text{Length} * \text{Width}^2 / 6 = 1.50 * 2.60^2 / 6 = 1.7 \text{ ft}^3$$

$$S_z = \text{Width} * \text{Length}^2 / 6 = 2.60 * 1.50^2 / 6 = 1.0 \text{ ft}^3$$



- Footing is in full bearing. Soil pressures are as follows:

$$P1 = P * (1/A + Z\text{-ecc} / S_x + X\text{-ecc} / S_z) = 7.7 * (1/3.9 + 0.00 / 1.7 + 0.00 / 1.0) = 1.98 \text{ ksf}$$

$$P2 = P * (1/A - Z\text{-ecc} / S_x + X\text{-ecc} / S_z) = 7.7 * (1/3.9 - 0.00 / 1.7 + 0.00 / 1.0) = 1.98 \text{ ksf}$$

$$P3 = P * (1/A - Z\text{-ecc} / S_x - X\text{-ecc} / S_z) = 7.7 * (1/3.9 - 0.00 / 1.7 - 0.00 / 1.0) = 1.98 \text{ ksf}$$

$$P4 = P * (1/A + Z\text{-ecc} / S_x - X\text{-ecc} / S_z) = 7.7 * (1/3.9 + 0.00 / 1.7 - 0.00 / 1.0) = 1.98 \text{ ksf}$$

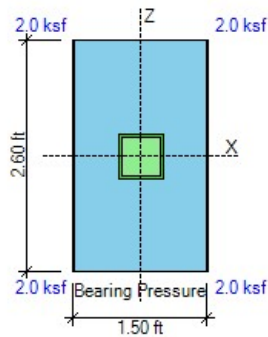

SLIDING CALCULATIONS (Comb: 0.6D+0.6W)

Internal friction angle = 28.0 deg

Passive coefficient $k_p = 4.33$ (per Coulomb)

Pressure at mid-depth = $k_p \cdot \text{Density} \cdot (\text{Cover} + \text{Thick} / 2) = 4.33 \cdot 110 \cdot (0.00 + 8.0 / 12 / 2) = 0.16 \text{ ksf}$

X-Passive force = $\text{Pressure} \cdot \text{Thick} \cdot \text{Width} = 0.16 \cdot 8.0 / 12 \cdot 2.60 = 0.3 \text{ kip}$

Z-Passive force = $\text{Pressure} \cdot \text{Thick} \cdot \text{Length} = 0.16 \cdot 8.0 / 12 \cdot 1.50 = 0.2 \text{ kip}$

Friction force = $\text{Resisting force} \cdot \text{Friction coeff.} = \text{Max}(0, 1.9 \cdot 0.35) = 0.7 \text{ kip}$

Use 100% of Passive + 100% of Friction for sliding resistance

$$\text{- Sliding safety factor X-X} = \frac{\text{X-Passive force} + \text{Friction}}{\text{X-Horizontal load}} = \frac{1.00 \cdot 0.3 + 1.00 \cdot 0.7}{0.0} = 9.53 > 1.50 \text{ OK}$$

$$\text{- Sliding safety factor Z-Z} = \frac{\text{Z-Passive force} + \text{Friction}}{\text{Z-Horizontal load}} = \frac{1.00 \cdot 0.2 + 1.00 \cdot 0.7}{0.0} = 8.36 > 1.50 \text{ OK}$$

UPLIFT CALCULATIONS (Comb: 0.6D+0.6W)

$$\text{- Uplift safety factor} = \frac{\text{Pedestal} + \text{Footing} + \text{Cover} - \text{Buoyancy}}{\text{Uplift load}} = \frac{0.0 + 0.2 + 0.0 - 0.1}{0.0} = 99.99 > 1.00 \text{ OK}$$

ONE-WAY SHEAR CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

Concrete $f'_c = 2.5 \text{ ksi}$

Steel $f_y = 40.0 \text{ ksi}$

Soil density = 110 pcf

Use Plain Concrete Shear Strength

$$\phi V_{cx} = \frac{4}{3} \cdot \phi \cdot \sqrt{f'_c} \cdot \text{Width} \cdot t / 1000 = \frac{4}{3} \cdot 0.60 \cdot \sqrt{2500} \cdot 2.6 \cdot 12 \cdot 8.0 / 1000 = 10.0 \text{ kip}$$

ACI 14.5.5.1

$$\phi V_{cz} = \frac{4}{3} \cdot \phi \cdot \sqrt{f'_c} \cdot \text{Length} \cdot t / 1000 = \frac{4}{3} \cdot 0.60 \cdot \sqrt{2500} \cdot 1.5 \cdot 12 \cdot 8.0 / 1000 = 5.8 \text{ kip}$$



- Shear forces calculated as the volume of the bearing pressures under the effective areas:

$$\text{One-way shear } V_{ux} \text{ (- Side)} = 0.0 \text{ kip} < 10.0 \text{ kip OK}$$

$$\text{One-way shear } V_{ux} \text{ (+ Side)} = 0.0 \text{ kip} < 10.0 \text{ kip OK}$$

$$\text{One-way shear } V_{uz} \text{ (- Side)} = 1.6 \text{ kip} < 5.8 \text{ kip OK}$$

$$\text{One-way shear } V_{uz} \text{ (+ Side)} = 1.6 \text{ kip} < 5.8 \text{ kip OK}$$



FLEXURE CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

Plain $\phi M_{nx} = 5 * \phi * \sqrt{f_c} * L * Thick^2 / 6 = 5 * 0.60 * \sqrt{(2500)} * 1.50 * 8.0^2 / 6 / 1000 = 0.6 \text{ k-ft}$

ACI Eq. (14.5.2.1a)

Plain $\phi M_{nz} = 5 * \phi * \sqrt{f_c} * W * Thick^2 / 6 = 5 * 0.60 * \sqrt{(2500)} * 2.60 * 8.0^2 / 6 / 1000 = 1.1 \text{ k-ft}$

- Top Bars

No Top Reinforcement Provided at the Footing

Use Plain Concrete Flexural Strength at Top

- Top moments calculated as the overburden minus the bearing pressures times the lever arm:

Top moment -Mux (- Side) = 0.0 k-ft < 2.4 k-ft OK

Top moment -Mux (+ Side) = 0.0 k-ft < 2.4 k-ft OK

Top moment -Muz (- Side) = 0.0 k-ft < 4.2 k-ft OK

Top moment -Muz (+ Side) = 0.0 k-ft < 4.2 k-ft OK

- Bottom Bars

No Bottom Reinforcement Provided at the Footing

Use Plain Concrete Flexural Strength at Bottom



- Bottom moments calculated as the bearing minus the overburden pressures times the lever arm:


Bottom moment Mux (- Side) = 2.3 k-ft < 2.4 k-ft OK ratio = 0.96

Bottom moment Mux (+ Side) = 2.3 k-ft < 2.4 k-ft OK ratio = 0.96

Bottom moment Muz (- Side) = 0.9 k-ft < 4.2 k-ft OK ratio = 0.22

Bottom moment Muz (+ Side) = 0.9 k-ft < 4.2 k-ft OK ratio = 0.22





Pieruccioni Engineering and Construction, L

Project:

Page # ____

Engineer:

8/23/2024

Descrip: Typical Interior Footing 6,500# point load

ASDIP Foundation 5.3.0.0

SPREAD FOOTING DESIGN

www.asdipsoft.com

LOAD TRANSFER CALCULATIONS (Comb: 1.2D+1.6L+0.5S)

$$\text{Area } A1 = \text{col } L * \text{col } W = 6.0 * 6.0 = 36.0 \text{ in}^2$$

$$Sx = \text{col } W * \text{col } L^2 / 6 = 6.0 * 6.0^2 / 6 = 36.0 \text{ in}^3$$

$$Sz = \text{col } L * \text{col } W^2 / 6 = 6.0 * 6.0^2 / 6 = 36.0 \text{ in}^3$$

$$\text{Bearing } Pbu = P / A1 + Mz / Sx + Mx / Sz = 10.8 / 36.0 + 0.0 * 12 / 36.0 + 0.0 * 12 / 36.0 = 0.3 \text{ ksi}$$

$$\text{Min edge} = \text{Min} (L / 2 - X\text{-offset} - \text{col } L / 2, W / 2 - Z\text{-offset} - \text{col } W / 2)$$

$$\text{Min edge} = \text{Min} (1.50 * 12 / 2 - 0.0 - 6.0 / 2, 2.60 * 12 / 2 - 0.0 - 6.0 / 2) = 6.0 \text{ in}$$

$$\text{Area } A2 = \text{Min} [L * W, (\text{col } L + 2 * \text{Min edge}) * (\text{col } W + 2 * \text{Min edge})]$$

ACI R22.8.3.2

$$A2 = \text{Min} [1.50 * 12 * 2.6 * 12, (6.0 + 2 * 6.0) * (6.0 + 2 * 6.0)] = 324.0 \text{ in}^2$$

$$\text{Footing } \phi Pnc = \phi * 0.85 * f'c * \text{Min} [2, \sqrt{(A2 / A1)}] = 0.65 * 0.85 * 2.5 * \text{Min} [2, \sqrt{(324.0 / 36.0)}] = 2.8 \text{ ksi}$$

$$\text{Footing } \phi Pns = \phi * As * Fy / A1 = 0.0 \text{ ksi}$$

ACI 22.8.3.2

$$\text{Footing bearing } \phi Pn = \phi Pnc + \phi Pns = 2.8 + 0.0 = 2.8 \text{ ksi} > 0.3 \text{ psi OK}$$

Hooked $L_{dh} = \text{Max} (8 \text{ db}, 6, 0.02 * f_y / (f_c)^{1/2} * \text{Confining} * \text{Location} * \text{Concrete} * \text{db} * \text{ratio})$

ACI 25.4.3

$$L_{dh} = \text{Max} (8 \text{ db}, 6, 0.02 * 60.0 * 1000 / (2500)^{1/2} * 1.0 * 0.7 * 0.0 * 0.75 * 0.05) = 6.0 \text{ in}$$

Ld provided = Dowel length = $3.00 * 12 = 36.0 \text{ in} > 12.0 \text{ in OK}$

Ldh provided = Footing thickness - Cover = $8.00 - 3.0 = 5.0 \text{ in} < 6.0 \text{ in NG}$

PUNCHING SHEAR CALCULATIONS (Comb: 1.2D+1.6L+0.5Lr)

$$\text{X-Edge} = \text{Length} / 2 - \text{Offset} - \text{Col} / 2 = 1.50 * 12 / 2 - 0.0 - 6.0 / 2 = 6.0 \text{ in} \quad \alpha_{sx} = 10$$

$$\text{Z-Edge} = \text{Width} / 2 - \text{Offset} - \text{Col} / 2 = 2.60 * 12 / 2 - 0.0 - 6.0 / 2 = 12.6 \text{ in} \quad \alpha_{sz} = 10$$

$$\alpha_s = \alpha_{sx} + \alpha_{sz} = 10 + 10 = 20 \quad \text{Col type} = \text{Corner} \quad \beta = L / W = 6.0 / 6.0 = 1.00$$

ACI 22.6.5.2

$$\text{Perimeter } b_o = \alpha_{sz} / 10 * (L + d / 2 + \text{X-Edge}) + \alpha_{sx} / 10 * (W + d / 2 + \text{Z-Edge})$$

ACI 22.6.4.2

$$b_o = 10 / 10 * (6.0 + 8.0 / 2 + 6.0) + 10 / 10 * (6.0 + 8.0 / 2 + 12.6) = 38.6 \text{ in}$$

$$\text{Area } A_{bo} = (L + d / 2 + \text{X-Edge}) * (W + d / 2 + \text{Z-Edge}) = (6.0 + 8.0 / 2 + 6.0) * (6.0 + 8.0 / 2 + 12.6) = 361.6 \text{ in}^2$$

Use Plain Concrete Shear Strength

$$\phi V_c = \phi * \text{Min} (1 + 2 / \beta, 2) * 4/3 * \sqrt{f_c}$$

ACI 14.5.5.1

$$\phi V_c = 0.60 * \text{Min} (1 + 2 / 1.00, 2) * 4/3 * \sqrt{2500} = 80.0 \text{ psi}$$

Punching force $F = P + \text{Overburden} * A_{bo} - \text{Bearing}$

$$F = 10.8 + 0.07 * 361.6 / 144 - 3.9 = 7.1 \text{ kip}$$

$$b_1 = L + d / 2 + \text{X-Edge} = 6.0 + 8.0 / 2 + 6.0 = 16.0 \text{ in} \quad b_2 = W + d / 2 + \text{Z-Edge} = 6.0 + 8.0 / 2 + 12.6 = 22.6 \text{ in}$$

$$\gamma_{vx} \text{ factor} = 1 - \frac{1}{1 + (2/3) \sqrt{b_2 / b_1}} = 1 - \frac{1}{1 + (2/3) \sqrt{22.6 / 16.0}} = 0.44$$

ACI Eq. (8.4.4.2.2)

$$\gamma_{vz} \text{ factor} = 1 - \frac{1}{1 + (2/3) \sqrt{b_1 / b_2}} = 1 - \frac{1}{1 + (2/3) \sqrt{16.0 / 22.6}} = 0.36$$

ACI Eq. (8.4.2.3.2)

$$X_{2z} = b_1^2 / 2 / (b_1 + b_2) = 16.0^2 / 2 / (16.0 + 22.6) = 3.3 \text{ in} \quad X_{2x} = b_2^2 / 2 / (b_2 + b_1) = 6.6 \text{ in}$$

$$J_{cz} = b_1 * d^3 / 12 + b_1^3 * d / 12 + b_1 * d * (b_1 / 2 - X_{2z})^2 + b_2 * d * X_{2z}^2$$

ACI R8.4.4.2.3

$$J_{cz} = 16.0 * 8.0^3 / 12 + 16.0^3 * 8.0 / 12 + 16.0 * 8.0 * (16.0 / 2 - 3.3)^2 + 22.6 * 8.0 * 3.3^2 = 8210 \text{ in}^4$$

$$J_{cx} = b_2 * d^3 / 12 + b_2^3 * d / 12 + b_2 * d * (b_2 / 2 - X_{2x})^2 + b_1 * d * X_{2x}^2$$

ACI R8.4.4.2.3


$$J_{cx} = 22.6 * 8.0^3 / 12 + 22.6^3 * 8.0 / 12 + 22.6 * 8.0 * (22.6 / 2 - 6.6)^2 + 16.0 * 8.0 * 6.6^2 = 18229 \text{ in}^4$$


$$\text{Stress due to } P = F / (b_o * d) * 1000 = 7.1 / (38.6 * 8.0) * 1000 = 23.0 \text{ psi}$$

$$\text{Stress due to } M_x = \gamma_{vx} * X\text{-OTM} * X_{2x} / J_{cx} = 0.44 * 0.0 * 12 * 6.6 / 18229 * 1000 = 0.0 \text{ psi}$$

$$\text{Stress due to } M_z = \gamma_{vz} * Z\text{-OTM} * X_{2z} / J_{cz} = 0.44 * 0.0 * 12 * 3.3 / 8210 * 1000 = 0.0 \text{ psi}$$

$$\text{Punching stress} = P\text{-stress} + M_x\text{-stress} + M_z\text{-stress} = 23.0 + 0.0 + 0.0 = 23.0 \text{ psi} < 80.0 \text{ psi OK}$$





Pieruccioni Engineering and Construction, L

Project:

Page # ____

Engineer:

8/23/2024

Descrip: Typical Interior Footing 6,500# point load

ASDIP Foundation 5.3.0.0


SPREAD FOOTING DESIGN

www.asdipsoft.com

DESIGN CODES

Concrete Design ACI 318-14

Load Combinations ASCE 7-10/16

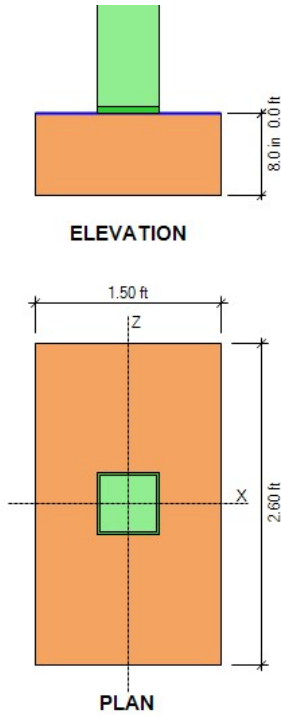

3/23/2024

C. PIERUCCIONI, PE

ETC-BUILDING H

LATERAL ANALYSIS

1


WIND $V_{ASD} = 85 \text{ mph}$ $V_{ULT} = 110 \text{ mph}$ EXP B $K_z = 1.0$ $SLOPE = 0^\circ - 34^\circ$
 $h = 36'$ $Z = 1.06$

$$ZONE A = 12.9 \text{ psf} \times 1.06 = 13.7 \text{ psf} \quad 16.0 \text{ psf min}$$

$$ZONE B = 8.8 \text{ psf} \times 1.06 = 9.3 \text{ psf}$$

$$ZONE C = 10.2 \text{ psf} \times 1.06 = 10.8 \text{ psf} \quad 16.0 \text{ psf min}$$

$$ZONE D = 7.0 \text{ psf} \times 1.06 = 7.4 \text{ psf} \quad 8.0 \text{ psf min}$$



SEISMIC $S_{DS} = 0.981$ $R = 6.5$ $C_e = 1.0$

$$C_s = (0.981 / (6.5 / 1.0)) / 1.4 = 0.091$$

$$\begin{aligned} W_{ROOF} &= (35 \text{ psf} \times 8,590 \text{ sf}) = 298,900 \text{ lb} \\ W_{LEVEL3} &= (40 \text{ psf} \times 7,490 \text{ sf}) = 299,600 \text{ lb} \\ W_{LEVEL2} &= (40 \text{ psf} \times 7,790 \text{ sf}) = 311,600 \text{ lb} \\ &\quad 910,100 \text{ lb} \end{aligned}$$

$$\begin{aligned} h &= 9' & h_R &= 29' \\ h &= 9' & h_3 &= 20' \\ h &= 9' & h_2 &= 10' \end{aligned}$$

$$V_s = 910,100 \text{ lb} \times 0.091 = 82,819 \text{ lb}$$

$$47,776,100$$

$$F_{ROOF} = \left[\frac{(298,900 \text{ lb} \times 29')}{(298,900 \text{ lb} \times 29') + (299,600 \text{ lb} \times 20') + (311,600 \text{ lb} \times 10')} \right] \times 82,819 \text{ lb} = 40,385 \text{ lb}$$

$$F_{LEVEL3} = \left[\frac{(299,600 \text{ lb} \times 20')}{(298,900 \text{ lb} \times 29') + (299,600 \text{ lb} \times 20') + (311,600 \text{ lb} \times 10')} \right] \times 82,819 \text{ lb} = 27,917 \text{ lb}$$

$$F_{LEVEL2} = \left[\frac{(311,600 \text{ lb} \times 10')}{(298,900 \text{ lb} \times 29') + (299,600 \text{ lb} \times 20') + (311,600 \text{ lb} \times 10')} \right] \times 82,819 \text{ lb} = 14,527 \text{ lb}$$

GRID 1

$$F_{3W} = (16.0 \text{ psf} \times 158 \text{ sf}) + (9.3 \text{ psf} \times 56 \text{ sf}) + (8.0 \text{ psf} \times 36 \text{ sf}) = 3,337 \text{ \#}$$


$$F_{3E} = 40,385 \text{ \#} \times (1218 \text{ sf} / 8,540 \text{ sf}) = 5,760 \text{ \#}$$

$$F_{2W} = 3,337 \text{ \#} + (16.0 \text{ psf} \times 172 \text{ sf}) = 6,089 \text{ \#}$$

$$F_{2E} = 5,760 \text{ \#} + 27,917 \text{ \#} \times (1053 \text{ sf} / 7,490 \text{ sf}) = 9,685 \text{ \#}$$

$$F_{1W} = 6,089 \text{ \#} + (16.0 \text{ psf} \times 172 \text{ sf}) = 8,841 \text{ \#}$$

$$F_{1E} = 9,685 \text{ \#} + 14,527 \text{ \#} \times (1053 \text{ sf} / 7,790 \text{ sf}) = 11,648 \text{ \#}$$



GRIDS 415 & 910

$$F_{3W} = (16.0 \text{ psf} \times 267 \text{ sf}) + (8.0 \text{ psf} \times 54 \text{ sf}) = 4,704 \text{ \#}$$

$$F_{3E} = 40,385 \text{ \#} \times (2,068 \text{ sf} / 8,540 \text{ sf}) = 9,779 \text{ \#}$$

$$F_{2W} = 4,704 \text{ \#} + (16.0 \text{ psf} \times 327 \text{ sf}) = 9,936 \text{ \#}$$

$$F_{2E} = 9,779 \text{ \#} + 27,917 \text{ \#} \times (1,733 \text{ sf} / 7,490 \text{ sf}) = 16,239 \text{ \#}$$

$$F_{1W} = 9,936 \text{ \#} + (16.0 \text{ psf} \times 328 \text{ sf}) = 15,184 \text{ \#}$$

$$F_{1E} = 16,239 \text{ \#} + 14,527 \text{ \#} \times (1,883 \text{ sf} / 7,790 \text{ sf}) = 19,750 \text{ \#}$$

GRID 7

$$F_{3W} = (16.0 \text{ psf} \times 273 \text{ sf}) + (8.0 \text{ psf} \times 107 \text{ sf}) = 5,724 \text{ \#}$$

$$F_{3E} = 40,385 \text{ \#} \times (1,962 \text{ sf} / 8,540 \text{ sf}) = 9,278 \text{ \#}$$

$$F_{2W} = 5,724 \text{ \#} + (16.0 \text{ psf} \times 300 \text{ sf}) = 10,024 \text{ \#}$$

$$F_{2E} = 9,278 \text{ \#} + 27,917 \text{ \#} \times (1,893 \text{ sf} / 7,490 \text{ sf}) = 16,334 \text{ \#}$$

$$F_{1W} = 10,024 \text{ \#} + (16.0 \text{ psf} \times 301 \text{ sf}) = 14,840 \text{ \#}$$

$$F_{1E} = 16,334 \text{ \#} + 14,527 \text{ \#} \times (1,893 \text{ sf} / 7,790 \text{ sf}) = 19,864 \text{ \#}$$

6R013

$$F_{3W} = (16.0 \text{ psf} \times 170 \text{ sf}) + (9.3 \text{ psf} \times 56 \text{ sf}) + (8.0 \text{ psf} \times 36 \text{ sf}) = 3,529 \text{ \#}$$


$$F_{3E} = 40,385 \text{ \#} \times (1124 \text{ sf} / 8,540 \text{ sf}) = 5,315 \text{ \#}$$

$$F_{2W} = 3,529 \text{ \#} + (16.0 \text{ psf} \times 191 \text{ sf}) = 6,585 \text{ \#}$$

$$F_{2E} = 5,315 \text{ \#} + 27,917 \text{ \#} \times (1,079 \text{ sf} / 7,490 \text{ sf}) = 9,337 \text{ \#}$$

$$F_{1W} = 6,585 \text{ \#} + (16.0 \text{ psf} \times 184 \text{ sf}) = 9,529 \text{ \#}$$

$$F_{1E} = 9,337 \text{ \#} + 14,527 \text{ \#} \times (1,079 \text{ sf} / 7,790 \text{ sf}) = 11,349 \text{ \#}$$



GRID A-B

$$F_{3W} = (16.0 \text{ psf} \times 144 \text{ sf}) + (9.3 \text{ psf} \times 55 \text{ sf}) + (8.0 \text{ psf} \times 19 \text{ sf}) = 2,968 \text{ \#}$$


$$F_{3E} = 40,385 \text{ \#} \times (2,060 \text{ sf} / 8,540 \text{ sf}) = 9,742 \text{ \#}$$

$$F_{2W} = 2,968 \text{ \#} + (16.0 \text{ psf} \times 154 \text{ sf}) = 5,432 \text{ \#}$$

$$F_{2E} = 9,742 \text{ \#} + 27,917 \text{ \#} \times (1,949 \text{ sf} / 7,490 \text{ sf}) = 16,633 \text{ \#}$$

$$F_{1W} = 5,432 \text{ \#} + (16.0 \text{ psf} \times 156 \text{ sf}) = 7,928 \text{ \#}$$

$$F_{1E} = 16,633 \text{ \#} + 14,527 \text{ \#} \times (1,949 \text{ sf} / 7,790 \text{ sf}) = 20,081 \text{ \#}$$

GRID C

$$F_{3W} = (16.0 \text{ psf} \times 260 \text{ sf}) + (8.0 \text{ psf} \times 32 \text{ sf}) = 4,416 \text{ \#}$$

$$F_{3E} = 40,385 \text{ \#} \times (4,039 \text{ sf} / 8,540 \text{ sf}) = 19,100 \text{ \#}$$

$$F_{2W} = 4,416 \text{ \#} + (16.0 \text{ psf} \times 319 \text{ sf}) = 9,520 \text{ \#}$$

$$F_{2E} = 19,100 \text{ \#} + 27,917 \text{ \#} \times (3,774 \text{ sf} / 7,490 \text{ sf}) = 33,167 \text{ \#}$$

$$F_{1W} = 9,520 \text{ \#} + (16.0 \text{ psf} \times 320 \text{ sf}) = 14,640 \text{ \#}$$

$$F_{1E} = 33,167 \text{ \#} + 14,527 \text{ \#} \times (3,973 \text{ sf} / 7,790 \text{ sf}) = 40,576 \text{ \#}$$

GRID G-H

$$F_{3W} = (16.0 \text{ psf} \times 183 \text{ sf}) + (9.3 \text{ psf} \times 48 \text{ sf}) + (8.0 \text{ psf} \times 50 \text{ sf}) = 3,774 \text{ \#}$$

$$F_{3E} = 40,385 \text{ \#} \times (2,441 \text{ sf} / 8,540 \text{ sf}) = 11,543 \text{ \#}$$

$$F_{2W} = 3,774 \text{ \#} + (16.0 \text{ psf} \times 199 \text{ sf}) = 6,958 \text{ \#}$$

$$F_{2E} = 11,543 \text{ \#} + 27,917 \text{ \#} \times (1,867 \text{ sf} / 7,490 \text{ sf}) = 18,502 \text{ \#}$$

$$F_{1W} = 6,958 \text{ \#} + (16.0 \text{ psf} \times 201 \text{ sf}) = 10,179 \text{ \#}$$

$$F_{1E} = 18,502 \text{ \#} + 14,527 \text{ \#} \times (1,969 \text{ sf} / 7,790 \text{ sf}) = 22,172 \text{ \#}$$

GRID 1 (LEVEL 3) FE = 5,760#

6 SEGMENTS

L = 2'-11" h = 9'

L = 4'-0"

L = 4'-3"


L = 3'-4"

L = 5'-10"

L = 5'-0"

LT = 30'-10"

$$VE = 5,760\# / 30.93' = 187\text{PIF}$$

USE  $VE_{ALLOW} = 242\text{PIF} \times (1.25 - 0.125 \times 9' / 2.92') = 209\text{PIF}$

HOLD DOWNS

$$TE = 187\text{PIF} \times 9' \times 1.25 - 1/2(250\text{PSF} \times 3' \times 1.46') - 1/2(12\text{PSF} \times 4.5' \times 1.46') = 2,010\#$$

USE MST48 W/ 2 STUFS


$$TE_{ALLOW} = 3,425\# \times 1.4 / 1.6 = 2,997\#$$

GRID 1 (LEVEL 2) FE = 9,685#

6 SEGMENTS

L = 30'-10" h = 9'

$$VE = 9,685\# / 30.93' = 314\text{PIF}$$

USE  $VE_{ALLOW} = 456\text{PIF} \times (1.25 - 0.125 \times 9' / 2.92') = 394\text{PIF}$

HOLD DOWNS

$$TE = 314\text{PIF} \times 9' \times 1.25 + 2,010\# - 1/2(30\text{PSF} \times 7.9' \times 1.46') - 1/2(12\text{PSF} \times 9' \times 1.46') = 5,293\#$$

USE MST72 W/ 2 STUFS


$$TE_{ALLOW} = 6,475\# \times 1.4 / 1.6 = 5,666\#$$

GRID 1 (LEVEL 1) FE = 11,648#

6 SEGMENTS

L = 30'-10" h = 9'

$$VE = 11,648\# / 30.93' = 378\text{PIF}$$


USE  $VE_{ALLOW} = 456\text{PIF} \times (1.25 - 0.125 \times 9' / 2.92') = 394\text{PIF}$

HOLD DOWNS

$$TE = 378\text{PIF} \times 9' \times 1.25 + 5,293\# - 1/2(30\text{PSF} \times 7.9' \times 1.46') - 1/2(12\text{PSF} \times 9' \times 1.46') = 9,294\#$$

USE HDO14-SDS25 W/ 4 STUFS

$$TE_{ALLOW} = 12,425\# \times 1.4 / 1.6 = 10,872\#$$



3/23/2024

C. PIERUCCIANI, PE

ETC - BUILDING H

SHEAR

6

GRIDS 4/589/10 (LEVEL 3) FE = 9,779#

2 SEGMENTS LT = 29'4" + 9'
L = 29'4"
LT = 59'8"

$$VE = 9,779\# / 59.67' = 167\text{PIF}$$

USE W1. $VE_{ALLOW} = 242\text{PIF}$ HOLD DOWNS

$$TE = 167\text{PIF} \times 9 \times 1.25 - \frac{1}{2}(30\text{PSF} \times 2 \times 14.67') - \frac{1}{2}(12\text{PSF} \times 4.5 \times 14.67') = 6112\#$$

$$\boxed{\text{USE MST37 W/ 2 STUFS}} \quad TE_{ALLOW} = 2,140\# \times 1.4/1.6 = 1,874\#$$

GRIDS 4/588/10 (LEVEL 2) FE = 16,239# 2 SEGMENTS LT = 59'8" b = 9'

$$VE = 16,239\# / 59.67' = 277\text{PIF}$$

USE W2. $VE_{ALLOW} = 353\text{PIF}$ HOLD DOWNS

$$TE = 277\text{PIF} \times 9 \times 1.25 + 6112\# - \frac{1}{2}(30\text{PSF} \times 4 \times 14.67') - \frac{1}{2}(12\text{PSF} \times 9 \times 14.67') = 2,553\#$$

$$\boxed{\text{USE MST48 W/ 2 STUFS}} \quad TE_{ALLOW} = 3,425\# \times 1.4/1.6 = 2,992\#$$


GRIDS 4/589/10 (LEVEL 1) FE = 19,750# 2 SEGMENTS LT = 59'8" b = 9'

$$VE = 19,750\# / 59.67' = 337\text{PIF}$$

USE W2. $VE_{ALLOW} = 353\text{PIF}$ HOLD DOWNS

$$TE = 337\text{PIF} \times 9 \times 1.25 + 2,553\# - \frac{1}{2}(30\text{PSF} \times 4 \times 14.67') - \frac{1}{2}(12\text{PSF} \times 9 \times 14.67') = 4,668\#$$

$$\boxed{\text{USE HDUG-SDS2.5 W/ 2 STUFS}} \quad TE_{ALLOW} = 5,820\# \times 1.4/1.6 = 5,093\#$$



GRID 7 (LEVEL 3) $FE = 9,278^{\#}$

2 SEGMENTS

 $L = 28'-1"$ $h = 9'$ $L = 28'-1"$ $LT = 56'-2"$

$$VE = 9,278^{\#} / 56.16' = 165 \text{ PIF}$$

USE $\nabla W1$ $VE_{ALLOW} = 242 \text{ PIF}$ HOLD DOWNS

$$TE = 165 \text{ PIF} \times 9' \times 1.25 - \frac{1}{2}(30 \text{ PSF} \times 14' \times 14') - \frac{1}{2}(8 \text{ PSF} \times 4.5' \times 14') = 1,429^{\#}$$

$$\boxed{\text{USE (2) HDU2-SDS2.5 W/2 STUFS}} \quad TE_{ALLOW} = 2,215^{\#} \times 1.4 / 1.6 = 1,938^{\#}$$

GRID 7 (LEVEL 2) $FE = 16,334^{\#}$

2 SEGMENTS

 $LT = 56'-2"$ $h = 9'$

$$VE = 16,334^{\#} / 56.16' = 291 \text{ PIF}$$

USE $\nabla W2$ $VE_{ALLOW} = 353 \text{ PIF}$ HOLD DOWNS

$$TE = 291 \text{ PIF} \times 9' \times 1.25 + 1,429^{\#} - \frac{1}{2}(30 \text{ PSF} \times 6.33' \times 14') - \frac{1}{2}(8 \text{ PSF} \times 9' \times 14') = 2,869^{\#}$$

$$\boxed{\text{USE (2) HDU5-SDS2.5 W/2 STUFS}} \quad TE_{ALLOW} = 4,340^{\#} \times 1.4 / 1.6 = 2,997^{\#}$$

GRID 7 (LEVEL 1) $FE = 19,864^{\#}$

2 SEGMENTS


 $LT = 56'-2"$ $h = 9'$

$$VE = 19,864^{\#} / 56.16' = 354 \text{ PIF}$$

USE $\nabla W3$ $VE_{ALLOW} = 456 \text{ PIF}$ HOLD DOWNS

$$TE = 354 \text{ PIF} \times 9' \times 1.25 + 2,869^{\#} - \frac{1}{2}(30 \text{ PSF} \times 6.33' \times 14') - \frac{1}{2}(8 \text{ PSF} \times 9' \times 14') = 5,015^{\#}$$

$$\boxed{\text{USE HDU8-SDS2.5 W/2 STUFS}} \quad TE_{ALLOW} = 5,820^{\#} \times 1.4 / 1.6 = 5,093^{\#}$$



GRID 13 (LEVEL 3) FE = 5,315#

7 SEGMENTS

L = 2'-7"

h = 9'

L = 2'-7"

L = 4'-0"

L = 4'-3"

L = 9'-0"

L = 3'-0"

L = 3'-0"

L_T = 29'-3"

$$VE = 5,315\# / 27.25' = 192\text{PIF}$$

$$\text{USE } \triangle W1 \quad VE_{HOLD} = 247\text{PIF} \times (1.25 - 0.125 \times 9' / 2.58') = 197\text{PIF}$$

HOLD DOWNS

$$TE = 192\text{PIF} \times 9' \times 1.25 - 1/2(30\text{PSF} \times 3' \times 1.29') - 1/2(12\text{PSF} \times 4.5' \times 1.29') = 1,964\#$$

$$\text{USE MST48 W/ 2 STUDS} \quad TE_{HOLD} = 3,425\# \times 1.4 / 1.6 = 2,997\#$$

GRID 13 (LEVEL 2) FE = 9,337#

7 SEGMENTS

L_T = 29'-3"

h = 9'

$$VE = 9,337\# / 27.25' = 319\text{PIF}$$

$$\text{USE } \triangle W3 \quad VE_{HOLD} = 456\text{PIF} \times (1.25 - 0.125 \times 9' / 2.58') = 271\text{PIF}$$

HOLD DOWNS

$$TE = 319\text{PIF} \times 9' \times 1.25 + 1,964\# - 1/2(30\text{PSF} \times 7.8' \times 1.29') - 1/2(12\text{PSF} \times 9' \times 1.29') = 5,332\#$$

$$\text{USE MST72 W/ 2 STUDS} \quad TE_{HOLD} = 6,425\# \times 1.4 / 1.6 = 5,666\#$$

GRID 13 (LEVEL 1) FE = 11,349#

7 SEGMENTS

L_T = 29'-3"

h = 9'


$$VE = 11,349\# / 27.25' = 388\text{PIF}$$

$$\text{USE } \triangle W4 \quad VE_{HOLD} = 595\text{PIF} \times (1.25 - 0.125 \times 9' / 2.58') = 484\text{PIF}$$

HOLD DOWNS

$$TE = 388\text{PIF} \times 9' \times 1.25 + 5,332\# - 1/2(30\text{PSF} \times 7.8' \times 1.29') - 1/2(12\text{PSF} \times 9' \times 1.29') = 9,476\#$$

$$\text{USE HDU14-SDS25 W/ 4 STUDS} \quad TE_{HOLD} = 12,425\# \times 1.4 / 1.6 = 10,872\#$$



GRIDS A/B (LEVEL 3) FE=9,742#

11 SEGMENTS L=2'-8" L=6'-8" h=9'

$$VE = 9,742\# / 47.33' = 206\text{PIF}$$

$$\text{USE } \boxed{W2} \quad VEA_{110\%} = 353\text{PIF} \times (1.25 - 0.125 \times 9' / 2.67') = 293\text{PIF}$$

HOLD DOWNS

$$TE = 206\text{PIF} \times 9' \times 1.25 - \frac{1}{2}(353\text{PIF} \times 11' \times 1.33') - \frac{1}{2}(12\text{PIF} \times 4.5' \times 1.33') = 2,099\#$$

$$\boxed{\text{USE MST48 W/ 2 STUDS}} \quad TE_{110\%} = 3,425\# \times 1.4 / 1.6 = 2,992\#$$

$$L = 2'-8"$$

$$L = 6'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

$$L = 2'-8"$$

GRIDS A/B (LEVEL 2) FE=16,633#

11 SEGMENTS LT=47'-4" h=9'

$$VE = 16,633\# / 47.33' = 351\text{PIF}$$

$$\text{USE } \boxed{W3} \quad VEA_{110\%} = 450\text{PIF} \times (1.25 - 0.125 \times 9' / 2.67') = 378\text{PIF}$$

HOLD DOWNS

$$TE = 351\text{PIF} \times 9' \times 1.25 + 2,099\# - \frac{1}{2}(30\text{PIF} \times 9' \times 1.33') - \frac{1}{2}(12\text{PIF} \times 9' \times 1.33') = 5,956\#$$

$$\boxed{\text{USE CM ST12 W/ 2 STUDS}} \quad TE_{110\%} = 9,215\# \times 1.4 / 1.6 = 8,063\#$$

GRIDS A/B (LEVEL 1) FE=20,081#

11 SEGMENTS LT=47'-4" h=9'


$$VE = 20,081\# / 47.33' = 424\text{PIF}$$

$$\text{USE } \boxed{W4} \quad VEA_{110\%} = 599\text{PIF} \times (1.25 - 0.125 \times 9' / 2.67') = 493\text{PIF}$$

HOLD DOWNS

$$TE = 424\text{PIF} \times 9' \times 1.25 + 5,956\# - \frac{1}{2}(30\text{PIF} \times 9' \times 1.33') - \frac{1}{2}(12\text{PIF} \times 9' \times 1.33') = 10,624\#$$

$$\boxed{\text{USE HDU14-50S2.5 W/ 41 OF 2 STUDS}} \quad TE_{110\%} = 14,445\# \times 1.4 / 1.6 = 12,639\#$$




GR 10 C (LEVEL 3) FE = 19,100#

4 SEGMENTS L = 18'-7" h = 9'
L = 15'-10"
L = 15'-10"
L = 18'-7"
LT = 68'-10"

VE = 19,100# / 68.83' = 277 p.f.

USE W2 VEA_{allow} = 353 p.f.

HOLD DOWNS



L = 18'-7" TE = 277 p.f. x 9' x 1.25 - 1/2(250 p.f. x 18.67' x 9.3') - 1/2(8 p.f. x 4.5' x 9.3') = 778#
L = 15'-10" TE = 277 p.f. x 9' x 1.25 - 1/2(250 p.f. x 28' x 7.92') - 1/2(12 p.f. x 4.5' x 7.92') = 130#

L = 18'-7" USE (2) HDU2-S052.5 w/2 STUOS TE_{allow} = 2,215# x 1.4 / 1.6 = 1,939#
L = 15'-10" OR MST37 w/2 STUOS TE_{allow} = 2,140# x 1.4 / 1.6 = 1,873#

GR 10 C (LEVEL 2) FE = 33,167#

4 SEGMENTS L = 68'-10" h = 9'

VE = 33,167# / 68.83' = 485 p.f.

USE W4 VEA_{allow} = 595 p.f.

HOLD DOWNS

L = 18'-7" TE = 485 p.f. x 9' x 1.25 - 1/2(815 p.f. x 9' x 9.3') + 778# = 5,899#
L = 15'-10" TE = 485 p.f. x 9' x 1.25 - 1/2(300 p.f. x 5' x 7.92') - 1/2(120 p.f. x 9' x 7.92') + 130# = 4,612#

USE (2) HDU11-S052.5 w/4 STUOS TE_{allow} = 8,030# x 1.4 / 1.6 = 7,026#
OR MST60 w/2 STUOS TE_{allow} = 5,405# x 1.4 / 1.6 = 4,729#

GR 10 C (LEVEL 1) FE = 40,576#

6 SEGMENTS

L = 18'-7" h = 9'
L = 15'-10"
L = 13'-10"
L = 13'-10"
L = 15'-10"
L = 18'-7"
LT = 96'-6"

VE = 40,576# / 96.5' = 420 p.f.

USE W4 VEA_{allow} = 595 p.f.

HOLD DOWNS

L = 18'-7" TE = 420 p.f. x 9' x 1.25 + 5,899# - 1/2(815 p.f. x 9' x 9.3') = 10,267#
L = 15'-10" TE = 420 p.f. x 9' x 1.25 + 4,612# - 1/2(300 p.f. x 5' x 7.92') - 1/2(120 p.f. x 9' x 7.92') = 8,315#
L = 13'-10" TE = 420 p.f. x 9' x 1.25 - 1/2(250 p.f. x 25.33' x 6.67') - 1/2(815 p.f. x 22.5' x 6.67') = 2,013#

L = 18'-7" USE HDU14-S052.5 w/4 STUOS TE_{allow} = 12,425# x 1.4 / 1.6 = 10,821#
L = 15'-10" OR HDU11-S052.5 w/4 STUOS TE_{allow} = 9,610# x 1.4 / 1.6 = 8,409#
L = 13'-10" OR HDU8-S052.5 w/2 STUOS TE_{allow} = 7,920# x 1.4 / 1.6 = 5,093#

GRIDS G-H (LEVEL 3) FE=11,543# 13 SEGMENTS L=31'9" L=31'11" h=9'
 L=31'11" L=31'11"
 L=54'11" L=54'11"
 L=54'11" L=54'11"
 L=34'11" L=24'11"
 L=34'11" L=34'11"
 L=62'9"

VE = 11,543# / 59.75' = 193PIF

USE W1 VEHICLE = 242PIF x (1.25 - 0.125 x 9' / 2.92') = 209PIF

HOLD DOWNS

TE = 193PIF x 9' x 1.25 - 1/2 (209PIF x 12.5' x 1.46') - 1/2 (1209PIF x 9.5' x 1.46') = 1,776#

LT = 59'9"

USE MS37 W/ 8 STOPS TEHOLD = 2,140# x 1.4 / 1.6 = 1,873#

GRIDS G-H (LEVEL 2) FE=18,502# 13 SEGMENTS LT=59'9" h=9'

VE = 18,502# / 59.75' = 310PIF

USE W3 VEHICLE = 456PIF x (1.25 - 0.125 x 9' / 2.92') = 394PIF

HOLD DOWNS

TE = 310PIF x 9' x 1.25 + 1,776# - 1/2 (1209PIF x 9' x 1.46') = 5,185#

USE MS72 W/ 2 STOPS TEHOLD = 6,475# x 1.4 / 1.6 = 5,666#

GRIDS G-H (LEVEL 1) FE=22,172# 13 SEGMENTS LT=59'9" h=9'

VE = 22,172# / 59.75' = 371PIF

USE W3 VEHICLE = 456PIF x (1.25 - 0.125 x 9' / 2.92') = 394PIF

HOLD DOWNS

TE = 371PIF x 9' x 1.25 + 5,185# - 1/2 (1209PIF x 9' x 1.46') = 9,281#

USE HD 014-SDS7.5 W/ 4 STOPS TEHOLD = 12,475# x 1.4 / 1.6 = 10,872#

