

CARUSO  
TURLEY  
SCOTT  
structural  
engineers

Job No. 24-1374

Sheet No. Cover

By JKC

Date 10/2024



CLIENT:

**FUZION**

9096 E Bahia Dr  
Ste 103  
Scottsdale, AZ 85260

11/19/2024

PROJECT:

**T-Mobile TI - #8022**  
4227 S. MERIDIAN SUITE E  
PUYALLUP, WA 98373

GENERAL INFORMATION:

**BUILDING CODE: 2021 INTERNATIONAL BUILDING CODE**


PRCTI20241902

**City of Puyallup  
Building  
REVIEWED  
FOR  
COMPLIANCE**

SKinnear  
01/02/2025  
2:48:02 PM



Calculations required to be provided by  
the Permittee on site for all Inspections

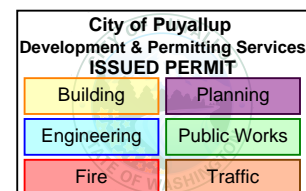



**CARUSO  
TURLEY  
SCOTT**  
structural  
engineers

STRUCTURAL SOLUTIONS SINCE 1963

1215 W. Rio Salado Pkwy.  
Suite 200  
Tempe, AZ 85281  
480.774.1700  
www.ctsaz.com

Job Name

T-Mobile

Job No

24-1374

Sheet No.

By

JKC

Date

11/2024

## CALCULATION INDEX SHEET

SHEET #	DESCRIPTION
1-5	Basis of Design
6-8	Threaded Rods at New Portal and Cloud
9-15	Unistrut Framing Supporting Portan and Cloud
16-31	Beam Supporting Portals
32-37	Mechanical Unit Attachment to Roof
38	Structural Survey by Apex Tech Solutions



YOUR VISION IS OUR MISSION

**CARUSO  
TURLEY  
SCOTT**  
consulting  
structural  
engineers

1215 W. Rio Salado Pkwy.  
Suite 200  
Tempe, AZ 85281  
T: (480) 774-1700  
F: (480) 774-1701

Job Name: T-MobileJob No. : 24-1374 Sheet No.: BASISBy: JKC Date: 10/2024

## BASIS OF DESIGN

### BUILDING CODE:

2021 EDITION OF THE INTERNATIONAL BUILDING CODE AND STANDARDS REFERENCED THEREIN, WITH CITY OF PUYALLUP AMENDMENTS.

### PROJECT SCOPE:

#### NEW DIGITAL PORTALS AND WELCOME CLOUD SUPPORTED BY EXISTING ROOF FRAMING:

EXISTING ROOF FRAMING CONSISTS OF WOOD TRUSSES AT 24" O.C..

ALL PORTALS AND CLOUDS WILL BE SUPPORTED AND BRACED WITH UNISTRUT FRAMING SUSPENDED FROM NEW GLULAM BEAMS WITH THREADED RODS.

LARGE DIGITAL PORTAL CLOUD WEIGHT = 400 LB

SMALL DIGITAL WELCOME CLOUD WEIGHT = 650 LB

### LOADS:

#### GRAVITY:

ROOF LIVE LOAD = 20 PSF (NON-REDUCIBLE).

ROOF DEAD LOAD = 18 PSF (ASSUMED).

GROUND SNOW LOAD = 25 PSF

#### WIND:

ULTIMATE DESIGN WIND SPEED (3-SECOND GUST),  $V_{ult}$  = 110 MPH.

RISK CATEGORY, II.

EXPOSURE C.

#### SEISMIC:

RISK CATEGORY, II.

SEISMIC IMPORTANCE FACTOR,  $I$  = 1.0.

MAPPED SHORT PERIOD SPECTRAL ACCELERATION,  $S_s$  = 1.26.

MAPPED ONE SECOND SPECTRAL ACCELERATION,  $S_1$  = 0.435.

SOIL SITE CLASS, D.

DESIGN SHORT PERIOD SPECTRAL ACCELERATION,  $S_{ds}$  = 1.008.


SEISMIC DESIGN CATEGORY, D.

# ASCE Hazards Report

**Address:**  
4227 S Meridian  
Puyallup, Washington  
98373

**Standard:** ASCE/SEI 7-16  
**Risk Category:** II  
**Soil Class:** D - Default (see Section 11.4.3)

**Latitude:** 47.15151  
**Longitude:** -122.292339  
**Elevation:** 441.03603823060683 ft  
(NAVD 88)

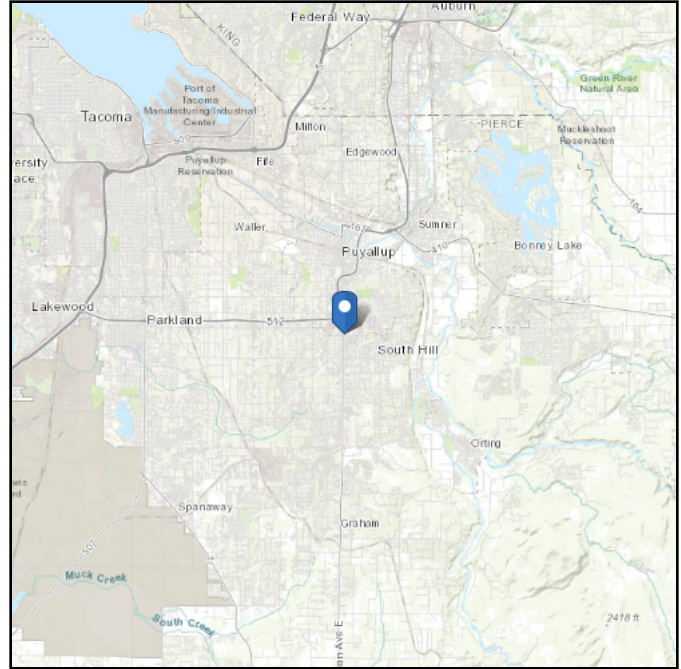

## Wind

### Results:

Wind Speed	97 Vmph
10-year MRI	67 Vmph
25-year MRI	73 Vmph
50-year MRI	78 Vmph
100-year MRI	83 Vmph

Data Source: ASCE/SEI 7-16, Fig. 26.5-1B and Figs. CC.2-1–CC.2-4, and Section 26.5.2

Date Accessed: Thu Nov 07 2024

Value provided is 3-second gust wind speeds at 33 ft above ground for Exposure C Category, based on linear interpolation between contours. Wind speeds are interpolated in accordance with the 7-16 Standard. Wind speeds correspond to approximately a 7% probability of exceedance in 50 years (annual exceedance probability = 0.00143, MRI = 700 years).

Site is not in a hurricane-prone region as defined in ASCE/SEI 7-16 Section 26.2.

**Site Soil Class:** D - Default (see Section 11.4.3)

**Results:**

$S_S$ :	1.26	$S_{D1}$ :	N/A
$S_1$ :	0.435	$T_L$ :	6
$F_a$ :	1.2	$PGA$ :	0.5
$F_v$ :	N/A	$PGA_M$ :	0.6
$S_{MS}$ :	1.512	$F_{PGA}$ :	1.2
$S_{M1}$ :	N/A	$I_e$ :	1
$S_{DS}$ :	1.008	$C_v$ :	1.352

Ground motion hazard analysis may be required. See ASCE/SEI 7-16 Section 11.4.8.

**Data Accessed:** Thu Nov 07 2024

**Date Source:** [USGS Seismic Design Maps](#)

## Residential Design Criteria

For 2021 International Codes & [PCC 17C.20.170](#)

This bulletin establishes the design criteria used in designing buildings using the current International Residential Code (IRC).

It is the responsibility of the property owner to verify all design criteria for their specific site.

Ground Snow Load	Wind Design		Seismic Design Category	Subject to Damage From			Winter Design Temp	Ice Barrier UnderLayment Required	Flood Hazard	Air Freezing Index	Mean Annual Temp
	Speed (mph)	Topographic Effects		Weathering	Frostline Depth	Termite					
<b>See below</b>	110 Mph Ult	No	<b>D1 / D2</b>	Moderate	<b>See below</b>	Slight to Moderate	26	No	Ask Engineering	50	50

Table items above in **bold** vary depending on your location. Read below for more information.

### Ground Snow Loads

- All structural tables in the International Residential Code (IRC) have a minimum ground snow load of 30 pounds per square foot (psf). Projects designed to the IRC must be designed to a minimum of 30 psf.
- If plans are designed by engineer using the International Building Code (IBC) then a minimum ground snow load of 25psf may be used.
- Higher elevations (above 700 feet) may have a higher snow load.
- Ground snow loads greater than 70psf require structural calculations prepared by a WA state registered engineer (2021 IRC section R301.2.3).

### Wind Design Criteria

- 110 mph Ultimate with a 3-second gust
- Exposure B (assumed unless the site meets the definition of another type)

**Exposure A:** Not used for residential construction.

**Exposure B:** Urban and suburban areas, wooded areas, or other terrain with numerous closely spaced obstructions having the size of single-family dwellings or larger.

**Exposure C:** Open terrain with scattered obstructions, including hills or other landscape features less than 30 feet extending more than 1,500 feet from the building site in any direction.

**Exposure D:** Flat, unobstructed areas exposed to wind flowing over open water for a horizontal distance of at least 5000 feet.

### Seismic Design Categories

The majority of Pierce County is Category D1. The area of Pierce County abutting Kitsap County (Gig Harbor area) is designated as D2 on the IRC map.

SOUTH MERIDIAN & 43RD  
AVE SE  
4227 S MERIDIAN SUITE E  
PUYALLUP, WA 98373

DESIGN TYPE:  
E1Y

PROJECT TYPE:  
CORP NEW

8022

PROTOTYPE RELEASE: Q3 2024

FUZION

20551 N. PIMA ROAD SUITE 200 SCOTTSDALE, AZ 85255  
Design@FuzionAD.com  
www.FuzionAD.com

##	DESCRIPTION	DATE

DATE: 11.18.2024  
DRAWN BY: PET

PARTIAL ROOF FRAMING PLAN

S201


ROOF FRAMING NOTES – TYP U.N.O.:

- VERIFY ALL DIMENSIONS AND ELEVATIONS WITH THE ARCHITECTURAL DRAWINGS AND FIELD CONDITIONS. BUILDING DIMENSIONS AND ELEVATIONS, WHERE SHOWN, WERE PROVIDED BY THE ARCHITECT AND IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY AND COORDINATE ALL DIMENSIONS PRIOR TO PROCEEDING WITH THE WORK. ANY DISCREPANCIES SHALL BE RESOLVED THROUGH THE ARCHITECT.
- FOR CLARITY, DETAILS MAY SHOW ONLY ONE SIDE OF FRAMING CONDITIONS. ALL OPENINGS MAY NOT BE SHOWN ON THIS PLAN. FOR EXACT SIZE, NUMBER AND LOCATION OF OPENINGS, SEE ARCHITECTURAL, MECHANICAL, PLUMBING, ELECTRICAL, SPRINKLER AND THEIR RELATED DRAWINGS. FOR FRAMING AT OPENINGS, SEE TYPICAL DETAILS.
- VERIFY EXACT SIZE, WEIGHT AND LOCATION OF EQUIPMENT AND SUPPORTS INDICATED ON PLAN WITH ARCHITECTURAL, MECHANICAL, PLUMBING, ELECTRICAL, SPRINKLER AND THEIR RELATED DRAWINGS. EQUIPMENT INDICATED ARE ONLY THOSE THAT EXCEED LOADS SPECIFIED IN THE G.S.N. FOR SUPPORT OF EQUIPMENT, SEE TYPICAL DETAILS AND OTHER TRADES.
- THE EXISTING CONDITIONS DEPICTED ON THESE DRAWINGS ARE BASED ON APEX TECH SOLUTIONS SURVEY DATA DATED 10/15/2024 AND SHALL BE VERIFIED BY THE CONTRACTOR PRIOR TO CONSTRUCTION. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE STRUCTURAL ENGINEER IMMEDIATELY.

FRAMING KEYNOTES

940-11

- (21) CONTRACTOR TO VERIFY TRUSSES ARE 19'-2" LONG (MAX). NOTIFY ENGINEER IF OTHERWISE.
- (22) EXISTING EXTERIOR WALL.
- (23) EXISTING INTERIOR DEMISING WALL.
- (24) EXISTING STEEL COLUMN.
- (25) BRACE WOOD BEAM PER DETAIL 12.

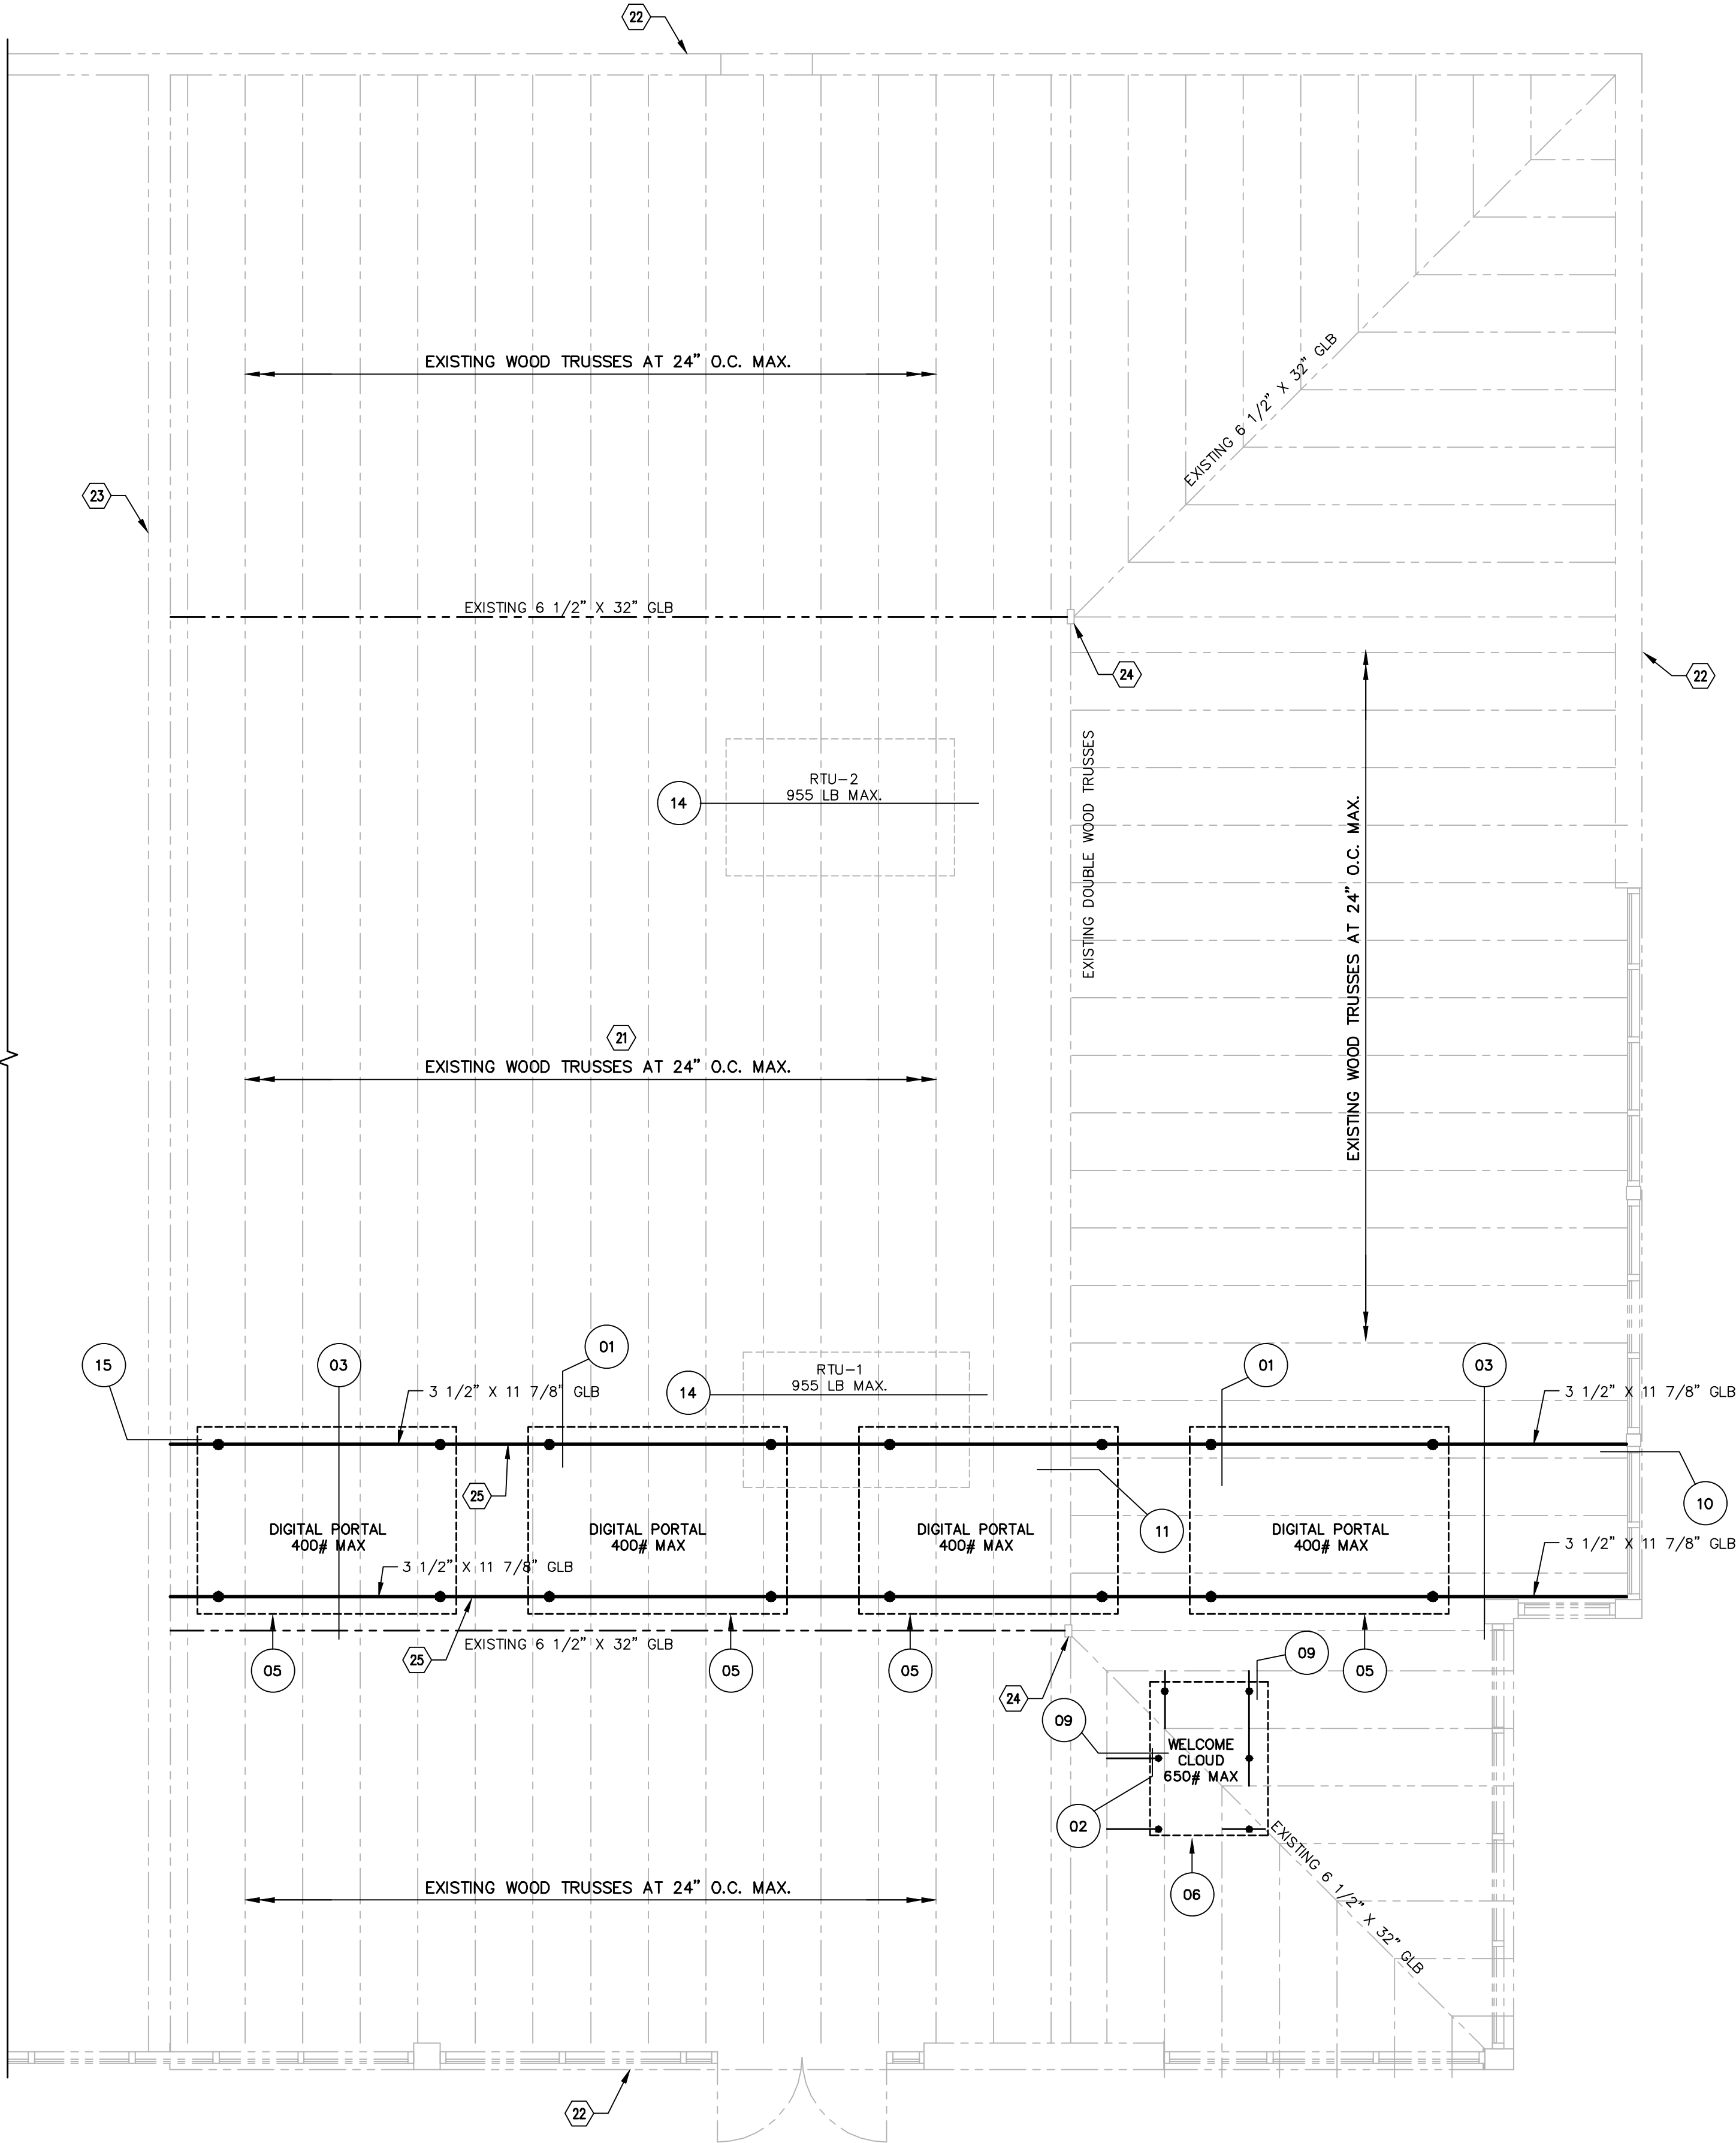

PARTIAL ROOF FRAMING PLAN

SCALE: 1/4" = 1'-0"

FOR ADDITIONAL INFORMATION SHOWN BUT NOT NOTED, SEE GENERAL STRUCTURAL NOTES ON SHEET S101 AND TYPICAL DETAIL SHEETS.

THESE DRAWINGS/CALCULATIONS ARE CONSIDERED PRELIMINARY – NOT FOR CONSTRUCTION OR RECORDING UNLESS THE STRUCTURAL ENGINEER OF RECORD'S SEAL IS AFFIXED WITH WRITTEN SIGNATURE.

PROJECT NUMBER 24-1374 PROJECT MANAGER TRM

PROJECT ENGINEER JKC PROJECT DRAFTER PET

CARUSO  
TURLEY  
SCOTT  
structural  
engineers

1215 West Rio Salado Parkway  
Suite 200  
Tempe, Arizona 85281  
(480) 774-1700  
www.ctsaz.com



Structural Solutions Since 1963

**CARUSO  
TURLEY  
SCOTT**  
consulting  
structural  
engineers

1215 W. Rio Salado Pkwy.  
Suite 200  
Tempe, AZ 85281  
T: (480) 774-1700  
F: (480) 774-1701

Job Name: \_\_\_\_\_

Job No. : \_\_\_\_\_ Sheet No.: \_\_\_\_\_

By: \_\_\_\_\_ Date: \_\_\_\_\_

## Threaded Rod Supporting Cloud and Portal:

3/8" dia. threaded rod

$F_U = 58 \text{ ksi}$

A36  $F_y = 36 \text{ ksi}$

$$A_b = (0.375 \text{ in})^2(\pi)/4 \\ = 0.11 \text{ in}^2$$

$$\text{Rod Capacity} = R_n = F_n A_b \\ F_n = 0.75 F_u = (0.75)(58 \text{ ksi}) \\ = 43.5 \text{ ksi}$$

J3-1  
Table J3.2

$$R_n / \Omega = (43.5 \text{ ksi})(0.11 \text{ in}^2) / 2.00 \\ = 2392 \text{ lb.}$$



Digital Portal Brace and Threaded Rod Connection:

Portal Weight = 400 lb. (max)

Check Threaded Rods:

$P_{ROD} = (400 \text{ lb.})/4 = 100 \text{ lb.}$   
3/8" diameter threaded rod  
 $P_{ALLOWABLE} = 2,392 \text{ lb.} > 100 \text{ lb.}$     **OKAY**

Check Brace:

$S_{ds} = 1.5 \text{ (max)}$   
 $F_p = (0.4)(1.0)(1.5)(400 \text{ lb.}) / [2.5/1.0] * [1 + 2(1/1)]$   
= 288 lb.  
 $P_{BRACE} = (288 \text{ lb})/2 * (\text{sqrt}(2)) = 204 \text{ lb./Brace}$



\* Using #8 wire:  $P_{ALLOWABLE} = (0.022 \text{ in}^2)(20 \text{ ksi})$   
= 440 lb.

Check P1000T Unistrut as Seismic Rod Stiffener:

Span = 36" max cantilever  
 $P = 288 \text{ lb.} / 4 = 72 \text{ lb.}$   
 $M = (72 \text{ lb.})(36 \text{ in.}) = 2592 \text{ in-lb}$

P1000 Unistrut Capacity:

Allowable Load = 560 lb. (based on 72" span, 2\*cantilever)  
Hole Factor (T Series) = 0.85  
Unbraced Length Factor = 0.78  
Point Load Reduction Factor = 0.5  
 $M_{ALLOWABLE} = [(560 \text{ lb.})(72 \text{ in.}) / 4] * [(0.85)(0.5)(0.78)]$   
= 3341 in-lb > 2592 in-lb    **OKAY**

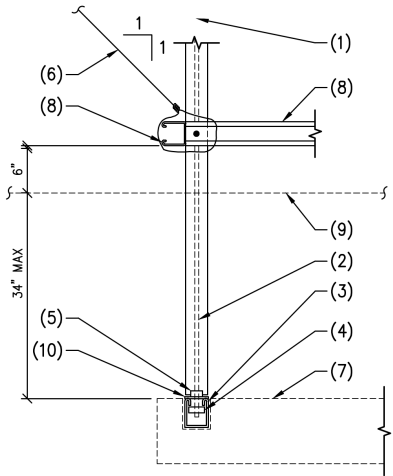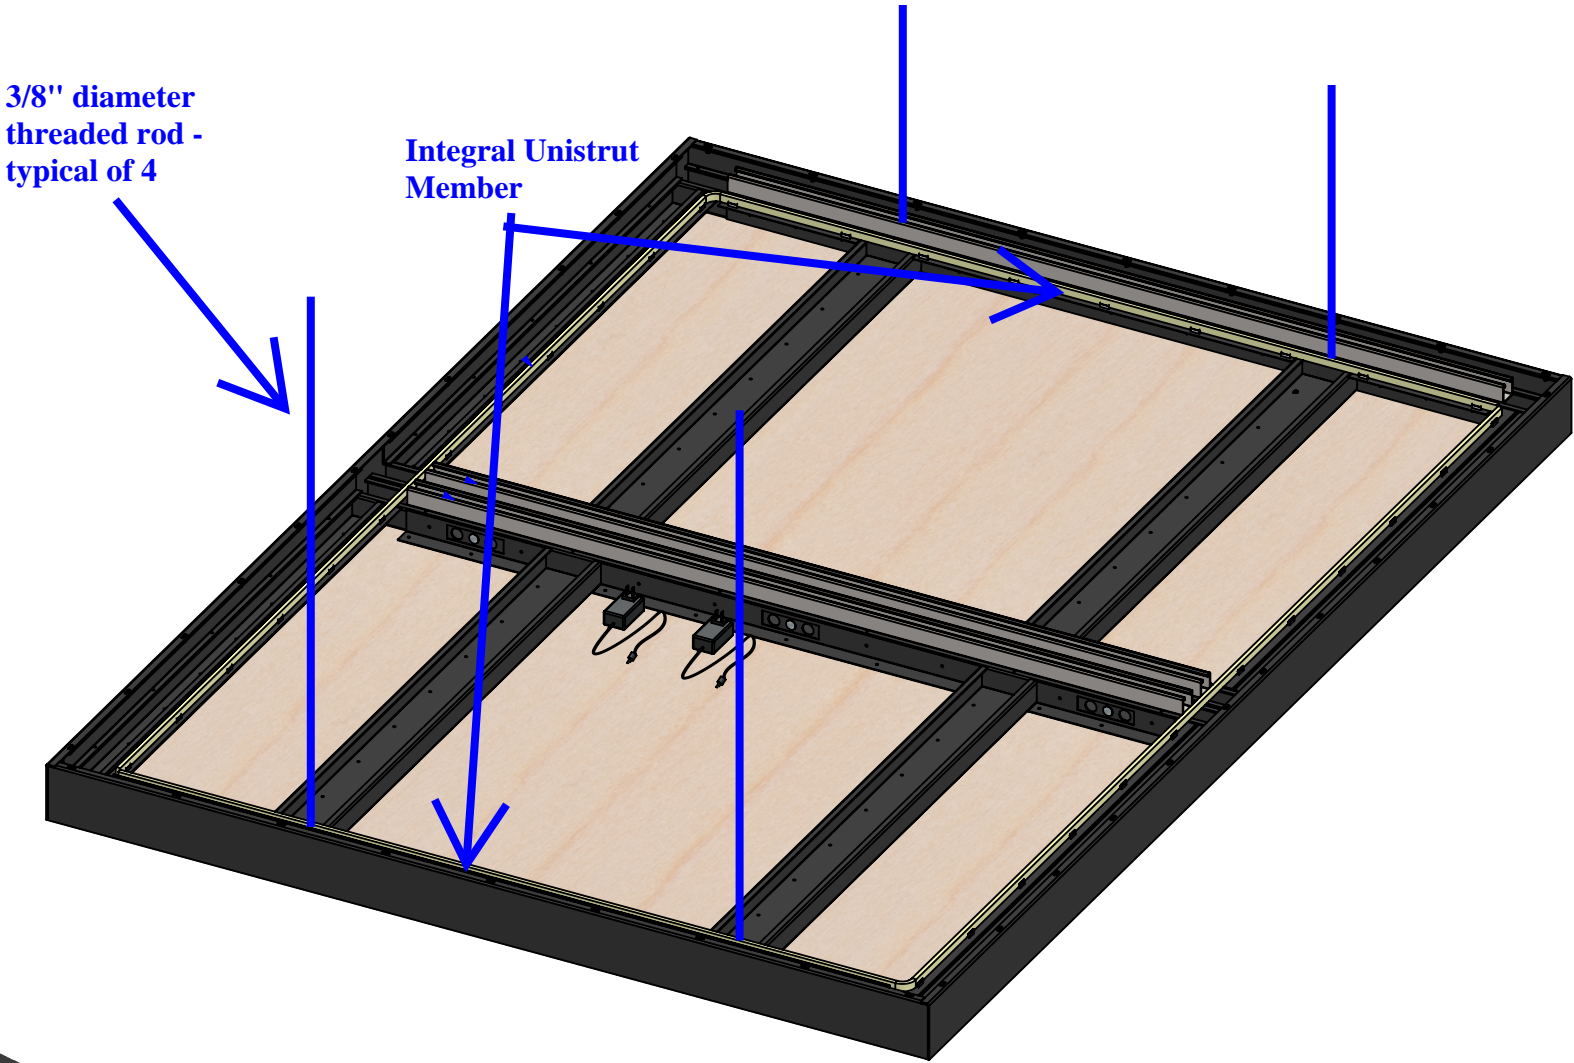

- NOTES:
1. TOP CONNECTION PER DETAIL 03.
  2. THREADED ROD WITH STIFFENER ROD REINFORCEMENT PER DETAIL 04. REFER TO ARCH'L FOR ROD LOCATIONS.
  3. INTEGRAL UNISTRUT PER VENDOR.
  4. UNISTRUT CHANNEL NUT.
  5. HEX NUT.
  6. SPLAY WIRE WITH 3 TURNS.
  7. DIGITAL PORTAL BY MFR. 400# MAX.
  8. P1000 HORIZONTAL BRACE ALL 4 SIDES.
  9. SUSPENDED CEILING AS OCCURS PER ARCH'L.
  10. 1/4"x2"x2" STEEL PLATE.

NOTE:  
SEE DETAIL 07 FOR  
HORIZONTAL BRACE TO  
STIFFENER CONNECTION

REV#	DATE	NAME	DESCRIPTION
REVISION TABLE			

**CONFIDENTIAL:**  
THE INFORMATION CONTAINED IN THIS DOCUMENT IS THE SOLE PROPERTY OF SPARKS CUSTOM RETAIL LLC. ANY REPRODUCTION OR USE WITHOUT EXPRESS WRITTEN CONSENT IS PROHIBITED.  
**ELECTRICAL (if applicable):**  
NO SECTION OR SECTIONS SHALL BE USED BY THEMSELVES, AND THE VARIOUS SECTIONS MUST BE USED ONLY AS A COMPLETE, FINISHED WIRED UNIT IN THE INTENDED CONFIGURATION. ALL HARD WIRED CONNECTIONS MUST BE COMPLETED BY A CERTIFIED ELECTRICIAN.  
**DIMENSIONS:**  
UNLESS OTHERWISE SPECIFIED: ALL DIMENSIONS ARE IN: in  
ALTERNATE DIMS ARE IN: (mm)  
ALL DIMENSIONS SHOWN ARE FINISHED DIMENSIONS INCLUDING SPECIFIED MATERIALS.  
**TOLERANCES:**  
UNLESS OTHERWISE SPECIFIED: FRACTIONS ± 1/32 [±0.80mm]  
DECIMALS .XXX ± 0.010 [±0.25mm]  
ANGULAR ± 0.5°  
**FINISHING:**  
UNLESS OTHERWISE SPECIFIED: ALL ACRYLIC EDGES TO BE DIAMOND POLISHED.  
FOR METAL, NO SHARP EDGES AND ALL BURRS REMOVED. ALL WELDS TO BE GRIND AND POLISHED.  
EXPOSED EDGES INCLUDING COUNTERTOPS ARE TO BE EASED.

DRAWN BY:	SCALE (B-SIZE):
AL	1:15
DATE CREATED:	
8/27/2024	
CLIENT:	
T-MOBILE	
PROJECT:	
EXPERIENCE E1Y	
JOB #:	
TMOB88	
FILE NAME:	
XF905_XF906 PORTAL CLOUD	
DESCRIPTION:	
PORTAL CLOUD	
PART NUMBER:	
XF905	
SHEET:	

**Welcome Cloud Brace and Threaded Rod Connection:**

Cloud Weight = 650 lb. (max)

**Check Threaded Rods:**

$$P_{\text{ROD}} = (650 \text{ lb.}) / 6 = 108 \text{ lb.}$$

3/8" diameter threaded rod

$$P_{\text{ALLOWABLE}} = 2,392 \text{ lb.} > 108 \text{ lb.} \quad \text{OKAY}$$

**Check Brace:**

$$Sds = 1.5 \text{ (max)}$$

$$F_p = (0.4)(1.0)(1.5)(650 \text{ lb.}) / [2.5/1.0] * [1 + 2(1/1)] = 468 \text{ lb.}$$

$$P_{\text{BRACE}} = (468 \text{ lb.}) / 2 * (\text{sqrt}(2)) = 331 \text{ lb./Brace}$$

$$\text{* Using \#8 wire: } P_{\text{ALLOWABLE}} = (0.022 \text{ in}^2)(20 \text{ ksi}) = 440 \text{ lb.}$$

**Check P1000T Unistrut as Seismic Rod Stiffener:**

Span = 36" max cantilever

$$P = 468 \text{ lb.} / 6 = 78 \text{ lb.}$$

$$M = (78 \text{ lb.})(36 \text{ in.}) = 2808 \text{ in-lb}$$

P1000 Unistrut Capacity:

Allowable Load = 560 lb. (based on 72" span, 2\*cantilever)

Hole Factor (T Series) = 0.85

Unbraced Length Factor = 0.78

Point Load Reduction Factor = 0.5


$$\text{ALLOWABLE} = [(560 \text{ lb.})(72 \text{ in.}) / 4] * [(0.85)(0.5)(0.78)] = 3341 \text{ in-lb} > 2808 \text{ in-lb} \quad \text{OKAY}$$

3/8" diameter threaded rod - typical of 6

ELEMENTAL LIGHTS  
GRAZE X 10 DEGREE  
LIGHTING FIRING  
DOWN

ELEMENTAL LIGHTS  
GRAZE X 10 DEGREE  
LIGHTING FIRING  
UP

TRANSLUCENT  
MAGENTA 3FORM  
ACRYLIC 1/4"

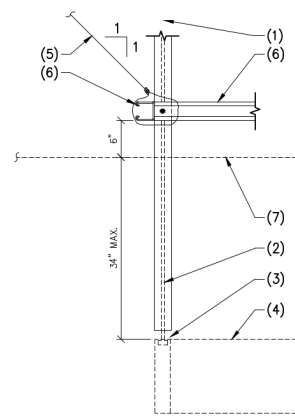**NOTES:**

1. TOP CONNECTION PER DETAIL 03.
2. THREADED ROD WITH STIFFENER ROD REINFORCEMENT PER DETAIL 04. 3 PER LONG SIDE, 6 TOTAL.
3. CONNECTION PER MFR.
4. DIGITAL CLOUD PER MFR. 450# MAX.
5. PLAY WIRE WITH 3 TURNS.
6. P1000 HORIZONTAL BRACE ALL 4 SIDES.
7. SUSPENDED CEILING AS OCCURS PER ARCH'L.

NOTE:  
SEE DETAIL 07 FOR  
HORIZONTAL BRACE TO  
STIFFENER CONNECTION

**TRIAD**

Triad Manufacturing, Inc.  
4321 Semple Ave. / St Louis, MO 63120  
P (314) 381-5280

This drawing is not to be scaled. Unless otherwise specified dimensions are in inches  
Hole - Hole/Edge = +/- 0.005, Hole/Edge - Bend = +/- 0.015  
Unless otherwise specified, all other dimensions +/- 0.015

Conditions of use: these drawings are prepared for Triad Manufacturing incorporated production use only. Triad Manufacturing shall not be liable for the use of these drawings for production by other entities, or products fabricated by other entities, or any other use. All design ideas, arrangements and plans represented by this drawing, are the property of Triad Manufacturing and were developed for the specified project, none of which shall be used by or disclosed to any other person, firm or corporation for any purpose whatsoever without permission of Triad Manufacturing. Refer inquiries to engineering department

**PROJECT** EXPERIENCE 2.0  
**DESCRIPTION** DIGITAL CLOUD-L,KDA  
**MATERIAL** SEE BOM  
**FINISH** BERRY AND WHITE  
**DATE** 2023.10.07


**CUSTOMER PART #**

**TRIAD PART #**

T427-70-022

**REVISION**

**SHEET #**  
**1 of 5**



# CARUSO TURLEY SCOTT

structural engineers

1215 W. Rio Salado Parkway, Suite 200

Tempe, AZ 85281

480.774.1700

www.clsaz.com

Job Name T-Mobile

9

Job No. \_\_\_\_\_ Sheet No. \_\_\_\_\_

By \_\_\_\_\_ Date \_\_\_\_\_

## Sizing Unistrut Members Supporting Portal and Cloud:

\* Design is conservatively based on the unistrut supporting the suspended cloud since the cloud is heavier than the portal.

Unistrut Span = 6'-5"

Cloud Weight = 650 lb

Worst case load to unistrut =  $650 \text{ lb} / 2 = 325 \text{ lb}$  (Assume midspan load)

Try P1001 Unistrut:

Self Weight = 3.78 lb/ft

Midspan Reduction Factor = 0.5

Hole Factor (T-series) = 0.85




Unbraced Length Factor = 0.91

$P_{\text{allowable}} = (1420 \text{ lb} - 3.78 \text{ lb/ft} \times 6.42 \text{ ft}) \times 0.5 \times 0.85 \times 0.91$   
 $= 540 \text{ lb} > 325 \text{ lb}$

Use P1001 Unistrut Spanning Between Joists  
(6 Total)






### P1000®




Wt/100 Ft: 189 Lbs (281 kg/100 m)  
Allowable Moment 5,070 In-Lbs (570 N•m)  
12 Gauge Nominal Thickness .105" (2.7mm)

### P1001




Wt/100 Ft: 378 Lbs (562 kg/100 m)  
Allowable Moment 14,360 In-Lbs (1,620 N•m)  
12 Gauge Nominal Thickness .105" (2.7mm)

### P1000 DS




Wt/100 Ft: 173 Lbs (257 kg/100 m)

### P1000 H3




Wt/100 Ft: 175 Lbs (260 kg/100 m)

### P1000 HS




Wt/100 Ft: 185 Lbs (275 kg/100 m)

### P1000 KO




Wt/100 Ft: 190 Lbs (283 kg/100 m)

### P1000 SL




Wt/100 Ft: 185 Lbs (275 kg/100 m)

### P1000 T



Wt/100 Ft: 185 Lbs (275 kg/100 m)

### CHANNEL NUTS (REFER TO HARDWARE SECTION FOR DETAILS)



**P1006-0832**  
**P1006-1024**  
**P1006-1420**  
**P1007**  
**P1008**  
**P1009**  
**P1010**



**P1008T**  
**P1006T1420**  
**P1010T**



**P1024**  
**P1012S**  
**P1023S**



**P1012**  
**P1023**  
**P1024S**



**P3006-0832**  
**P3006-1024**  
**P3006-1420**  
**P3007**  
**P3008**  
**P3009**  
**P3010**



**P3016-0632**  
**P3016-0832**  
**P3016-1024**  
**P3016-1420**

Channel Finishes: PL, GR, HG, PG, ZD; Standard Lengths: 10' & 20'

## P1000 - BEAM LOADING

Span In	Max. Allowable Uniform Load Lbs	Defl. at Uniform Load In	Uniform Loading at Deflection		
			Span/180 Lbs	Span/240 Lbs	Span/360 Lbs
24	1,690	0.06	1,690	1,690	1,690
36	1,130	0.13	1,130	1,130	900
48	850	0.22	850	760	500
60	680	0.35	650	480	320
72	560	0.50	450	340	220
84	480	0.68	330	250	160
96	420	0.89	250	190	130
108	380	1.14	200	150	100
120	340	1.40	160	120	80
144	280	2.00	110	80	60
168	240	2.72	80	60	40
192	210	3.55	60	50	NR
216	190	4.58	50	40	NR
240	170	5.62	40	NR	NR

## P1001 - BEAM LOADING

Span In	Max. Allowable Uniform Load Lbs	Defl. at Uniform Load In	Uniform Loading at Deflection		
			Span/180 Lbs	Span/240 Lbs	Span/360 Lbs
24	3,500*	0.02	3,500*	3,500*	3,500*
36	3,190	0.07	3,190	3,190	3,190
48	2,390	0.13	2,390	2,390	2,390
60	1,910	0.20	1,910	1,910	1,620
72	1,600	0.28	1,600	1,600	1,130
84	1,370	0.39	1,370	1,240	830
96	1,200	0.51	1,200	950	630
108	1,060	0.64	1,000	750	500
120	960	0.79	810	610	410
144	800	1.14	560	420	280
168	680	1.53	410	310	210
192	600	2.02	320	240	160
216	530	2.54	250	190	130
240	480	3.16	200	150	100

## P1000 - COLUMN LOADING

Unbraced Height In	Max. Allowable Load at Slot Face Lbs	Maximum Column Load Applied at C.G.			
		K = 0.65 Lbs	K = 0.80 Lbs	K = 1.0 Lbs	K = 1.2 Lbs
24	3,550	10,740	9,890	8,770	7,740
36	3,190	8,910	7,740	6,390	5,310
48	2,770	7,260	6,010	4,690	3,800
60	2,380	5,910	4,690	3,630	2,960
72	2,080	4,840	3,800	2,960	2,400
84	1,860	4,040	3,200	2,480	1,980
96	1,670	3,480	2,750	2,110	1,660
108	1,510	3,050	2,400	1,810	**
120	1,380	2,700	2,110	**	**
144	1,150	2,180	1,660	**	**

## P1001 - COLUMN LOADING

Unbraced Height In	Max. Allowable Load at Slot Face Lbs	Maximum Column Load Applied at C.G.			
		K = 0.65 Lbs	K = 0.80 Lbs	K = 1.0 Lbs	K = 1.2 Lbs
24	6,430	24,280	23,610	22,700	21,820
36	6,290	22,810	21,820	20,650	19,670
48	6,160	21,410	20,300	18,670	16,160
60	6,000	20,210	18,670	15,520	12,390
72	5,620	18,970	16,160	12,390	8,950
84	5,170	16,950	13,630	9,470	6,580
96	4,690	14,890	11,190	7,250	5,040
108	4,170	12,850	8,950	5,730	3,980
120	3,690	10,900	7,250	4,640	**
144	2,930	7,630	5,040	**	**

## P1000/P1001 - ELEMENTS OF SECTION

Parameter	P1000		P1001	
Area of Section	0.555	In <sup>2</sup>	1.111	In <sup>2</sup>
Axis 1-1				
Moment of Inertia (I)	0.185	In <sup>4</sup>	0.928	In <sup>4</sup>
Section Modulus (S)	0.202	In <sup>3</sup>	0.571	In <sup>3</sup>
Radius of Gyration (r)	0.577	In	0.914	In
Axis 2-2				
Moment of Inertia (I)	0.236	In <sup>4</sup>	0.471	In <sup>4</sup>
Section Modulus (S)	0.290	In <sup>3</sup>	0.580	In <sup>3</sup>
Radius of Gyration (r)	0.651	In	0.651	In

Notes:

\* Load limited by spot weld shear.

\*\* KL/r &gt; 200

NR = Not Recommended.

- Beam loads are given in total uniform load (W Lbs) not uniform load (w lbs/ft or w lbs/in).
- Beam loads are based on a simple span and assumed to be adequately laterally braced. Unbraced spans can reduce beam load carrying capacity. Refer to Page 56 for reduction factors for unbraced lengths.
- For pierced channel, multiply beam loads by the following factor:  
**"KO" Series .....95%**                      **"T" Series .....85%**  
**"HS" Series .....90%**                      **"SL" Series .....85%**  
**"H3" Series .....90%**                      **"DS" Series .....70%**
- Deduct channel weight from the beam loads.
- For concentrated midspan point loads, multiply beam loads by 50% and the corresponding deflection by 80%. For other load conditions refer to page 18.
- All beam loads are for bending about Axis 1-1.



## P5000 - BEAM LOADING

Span In	Max Allowable Uniform Load Lbs	Defl. at Uniform Load In	Uniform Loading at Deflection		
			Span/180 Lbs	Span/240 Lbs	Span/360 Lbs
24	5,260	0.03	5,260	5,260	5,260
36	3,500	0.07	3,500	3,500	3,500
48	2,630	0.12	2,630	2,630	2,630
60	2,100	0.18	2,100	2,100	1,920
72	1,750	0.26	1,750	1,750	1,330
84	1,500	0.36	1,500	1,470	980
96	1,310	0.47	1,310	1,120	750
108	1,170	0.59	1,170	890	590
120	1,050	0.73	960	720	480
144	880	1.06	670	500	330
168	750	1.43	490	370	240
192	660	1.88	370	280	190
216	580	2.35	300	220	150
240	530	2.95	240	180	120

## P5001 - BEAM LOADING

Span In	Max Allowable Uniform Load Lbs	Defl. at Uniform Load In	Uniform Loading at Deflection		
			Span/180 Lbs	Span/240 Lbs	Span/360 Lbs
24	6,890*	0.01	6,890*	6,890*	6,890*
36	6,890*	0.02	6,890*	6,890*	6,890*
48	6,890*	0.05	6,890*	6,890*	6,890*
60	6,420	0.10	6,420	6,420	6,420
72	5,350	0.14	5,350	5,350	5,350
84	4,590	0.19	4,590	4,590	4,590
96	4,020	0.25	4,020	4,020	4,020
108	3,570	0.32	3,570	3,570	3,360
120	3,210	0.39	3,210	3,210	2,720
144	2,680	0.57	2,680	2,680	1,890
168	2,290	0.77	2,290	2,080	1,390
192	2,010	1.01	2,010	1,590	1,060
216	1,780	1.27	1,680	1,260	840
240	1,610	1.58	1,360	1,020	680

## P5000 - COLUMN LOADING

Unbraced Height In	Maximum Allowable Load at Slot Face Lbs	Maximum Column Load Applied at C.G.			
		K = 0.65 Lbs	K = 0.80 Lbs	K = 1.0 Lbs	K = 1.2 Lbs
24	5,650	16,870	15,180	12,850	10,600
36	4,690	13,140	10,600	7,650	5,660
48	3,560	9,550	6,860	4,790	3,660
60	2,730	6,680	4,790	3,450	2,710
72	2,160	4,980	3,660	2,710	2,170
84	1,760	3,950	2,960	2,240	1,820
96	1,500	3,270	2,500	1,930	1,580
108	1,310	2,800	2,170	1,690	1,390
120	1,170	2,450	1,930	1,510	**
144	980	1,980	1,580	**	**
168	850	1,670	1,340	**	**

## P5001 - COLUMN LOADING

Unbraced Height In	Maximum Allowable Load at Slot Face Lbs	Maximum Column Load Applied at C.G.			
		K = 0.65 Lbs	K = 0.80 Lbs	K = 1.0 Lbs	K = 1.2 Lbs
24	10,670	39,230	38,030	36,210	34,240
36	10,350	36,450	34,240	31,200	28,260
48	9,940	33,220	30,200	26,430	23,190
60	9,290	29,950	26,430	22,470	19,380
72	8,560	26,880	23,190	19,380	16,450
84	7,860	24,140	20,520	17,040	12,090
96	7,220	21,790	18,370	13,330	9,250
108	6,600	19,790	16,450	10,530	7,310
120	5,760	18,130	13,330	8,530	**
144	4,390	14,020	9,250	**	**
168	3,420	10,300	6,800	**	**

## P5000/P5001 - ELEMENTS OF SECTION

Parameter	P5000		P5001	
Area of Section	0.897	In <sup>2</sup>	1.793	In <sup>2</sup>
Axis 1-1				
Moment of Inertia (I)	1.098	In <sup>4</sup>	6.227	In <sup>4</sup>
Section Modulus (S)	0.627	In <sup>3</sup>	1.916	In <sup>3</sup>
Radius of Gyration (r)	1.107	In	1.864	In
Axis 2-2				
Moment of Inertia (I)	0.433	In <sup>4</sup>	0.866	In <sup>4</sup>
Section Modulus (S)	0.533	In <sup>3</sup>	1.066	In <sup>3</sup>
Radius of Gyration (r)	0.695	In	0.695	In

Notes:

\* Load limited by spot weld shear.

\*\* KL/r &gt; 200

NR = Not Recommended.


- Beam loads are given in total uniform load (W Lbs) not uniform load (w lbs/ft or w lbs/in).
- Beam loads are based on a simple span and assumed to be adequately laterally braced. Unbraced spans can reduce beam load carrying capacity. Refer to Page 56 for reduction factors for unbraced lengths.
- For pierced channel, multiply beam loads by the following factor:  

"KO" Series.....95%	"T" Series .....85%
"HS" Series .....90%	"SL" Series .....85%
"H3" Series.....90%	"DS" Series.....70%
- Deduct channel weight from the beam loads.
- For concentrated midspan point loads, multiply beam loads by 50% and the corresponding deflection by 80%. For other load conditions refer to page 18.
- All beam loads are for bending about Axis 1-1.

### LATERAL BRACING LOAD REDUCTION CHARTS

Span		Single Channel										Double Channel									
Ft. (m)	In. (cm)	P1000	P1100	P2000	P3000	P3300	P4000	P4100	P5000	P5500	P1001	P1101	P2001	P3001	P3301	P4001	P4101	P5001	P5501		
2 (0.61)	24 (61)	1.00	1.00	1.00	1.00	1.00	1.00	1.00	0.98	0.99	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00		
3 (0.91)	36 (91)	0.94	0.89	0.88	0.96	1.00	0.94	0.98	0.85	0.89	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00		
4 (1.22)	48 (122)	0.88	0.78	0.75	0.91	1.00	0.88	0.94	0.70	0.77	1.00	0.98	0.98	1.00	1.00	0.98	1.00	0.97	0.98		
5 (1.52)	60 (152)	0.82	0.68	0.61	0.88	0.98	0.83	0.91	0.55	0.67	0.97	0.93	0.92	0.98	1.00	0.93	0.96	0.90	0.93		
6 (1.83)	72 (183)	0.78	0.59	0.48	0.84	0.97	0.79	0.89	0.44	0.58	0.93	0.87	0.85	0.95	0.97	0.88	0.92	0.83	0.87		
7 (2.13)	84 (213)	0.75	0.52	0.41	0.82	0.96	0.75	0.86	0.38	0.51	0.89	0.82	0.78	0.92	0.95	0.83	0.89	0.76	0.81		
8 (2.44)	96 (244)	0.71	0.47	0.35	0.79	0.94	0.72	0.84	0.33	0.46	0.85	0.76	0.71	0.88	0.92	0.79	0.85	0.68	0.76		
9 (2.74)	108 (274)	0.69	0.43	0.32	0.77	0.93	0.69	0.82	0.30	0.42	0.81	0.70	0.64	0.85	0.90	0.74	0.81	0.61	0.70		
10 (3.05)	120 (305)	0.66	0.40	0.29	0.75	0.92	0.66	0.80	0.28	0.40	0.78	0.65	0.57	0.82	0.87	0.69	0.78	0.54	0.64		
12 (3.66)	144 (366)	0.61	0.36	0.25	0.70	0.89	0.60	0.76	0.24	0.36	0.70	0.54	0.45	0.76	0.82	0.60	0.71	0.43	0.53		
14 (4.27)	168 (427)	0.55	0.32	0.23	0.66	0.86	0.55	0.73	0.22	0.32	0.63	0.45	0.38	0.70	0.78	0.51	0.64	0.35	0.45		
16 (4.88)	192 (488)	0.51	0.30	0.21	0.62	0.84	0.50	0.69	0.21	0.30	0.56	0.39	0.32	0.64	0.73	0.44	0.57	0.30	0.39		
18 (5.49)	216 (549)	0.47	0.28	0.19	0.58	0.81	0.47	0.65	0.19	0.28	0.49	0.34	0.28	0.58	0.68	0.39	0.50	0.27	0.34		
20 (6.10)	240 (610)	0.44	0.26	0.18	0.54	0.78	0.43	0.61	0.18	0.26	0.44	0.31	0.25	0.52	0.63	0.35	0.45	0.24	0.30		

### BEARING LOADS ON UNISTRUT CHANNEL

<p>Loads are calculated based on 2007 Specification For The Design Of Cold Formed Steel Structural Members published by AISI</p> 	LOAD		LOAD		LOAD	
	Bearing Length 1½" (41 mm) Maximum Allowable Loads Lbs (kN)		Bearing Length 1½" (41 mm) Maximum Allowable Loads Lbs (kN)		Bearing Length 3¼" (82 mm) Maximum Allowable Loads Lbs (kN)	
Channel						
P1000	6,700 29.80		3,100 13.79		7,700 34.25	
P1100	3,500 15.57		1,700 7.56		4,000 17.79	
P2000	2,500 11.12		1,200 5.34		3,000 13.34	
P3000	6,700 29.80		3,200 14.23		7,700 34.25	
P3300	6,800 30.25		3,200 14.23		7,800 34.70	
P4000	2,600 11.57		1,200 5.34		3,000 13.34	
P4100	3,500 15.57		1,800 8.01		4,100 18.24	
P5000	6,500 28.91		3,000 13.34		7,500 33.36	
P5500	6,600 29.36		3,100 13.79		7,600 33.81	

## SQUARE NUTS



Part No.	Size	Wt/100 pcs Lbs (kg)
HSQN025EG	1/4"	0.9 (0.4)
HSQN031EG	5/16"	1.6 (0.7)
HSQN037EG	3/8"	2.7 (1.2)
HSQN050EG	1/2"	5.8 (2.6)
HSQN062EG	5/8"	10.7 (4.9)
HSQN075EG	3/4"	15.4 (6.9)
HSQN087EG	7/8"	24.9 (11.3)
HSQN100EG	1"	36.3 (16.5)

## HEXAGON NUTS




Part No.	Size	Wt/100 pcs Lbs (kg)
HHXN025EG	1/4"	0.6 (0.3)
HHXN031EG	5/16"	1.2 (0.5)
HHXN037EG	3/8"	1.6 (0.7)
HHXN050EG	1/2"	4.8 (2.2)
HHXN062EG	5/8"	7.3 (3.3)
HHXN075EG	3/4"	11.9 (5.4)
HHXN087EG	7/8"	19.0 (8.6)
HHXN100EG	1"	28.3 (12.8)

## FLAT WASHERS



Part No.	Size	Wt/100 pcs Lbs (kg)
HFLW025EG	1/4"	0.8 (0.4)
HFLW031EG	5/16"	1.0 (0.5)
HFLW037EG	3/8"	1.5 (0.7)
HFLW050EG	1/2"	3.5 (1.6)
HFLW062EG	5/8"	7.7 (3.5)
HFLW075EG	3/4"	11.0 (5.0)
HFLW087EG	7/8"	15.3 (6.9)
HFLW100EG	1"	18.8 (8.5)

## STEEL THREADED ROD

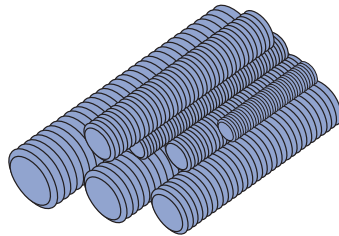

Standard Length 12' (3.7m)

Low Carbon Steel Grade 1006 - 1010  
F<sub>y</sub> = 36,000 psi minimum  
F<sub>t</sub> = 58,000 psi minimum

Part No.	Size	Wt/100 Ft. Lbs (kg)
HTHR025	1/4" x 20	13 (5.9)
HTHR031	5/16" x 18	20 (9.1)
HTHR037	3/8" x 16	30 (13.6)
HTHR044	7/16" x 14	30 (13.6)
HTHR050	1/2" x 13	53 (24.0)
HTHR062	5/8" x 11	84 (38.1)
HTHR075	3/4" x 10	124 (56.2)
HTHR087	7/8" x 9	170 (77.1)
HTHR100	1" x 8	223 (101.2)

## LOCK WASHERS




Part No.	Size	Wt/100 pcs Lbs (kg)
HLKW025EG	1/4"	0.25 (0.1)
HLKW031EG	5/16"	0.41 (0.2)
HLKW037EG	3/8"	0.63 (0.3)
HLKW050EG	1/2"	1.32 (0.60)
HLKW062EG	5/8"	2.20 (1.0)
HLKW075EG	3/4"	3.80 (1.7)
HLKW087EG	7/8"	6.00 (2.7)
HLKW100EG	1"	8.80 (4.0)

### LOAD CARRYING CAPACITY OF THREADED HOT ROLLED STEEL CONFORMING TO ASTM A575 AND A576

Threaded Rod Loads for Piping Applications (based on MSS SP-58)		
Nominal Dia.	Root Area In <sup>2</sup> (mm <sup>2</sup> )	Max. Safe Load at 650°F (343°C) Lbs (kN)
3/8"	0.068 (43.9)	730 (3.25)
1/2"	0.126 (81.3)	1,350 (6.01)
5/8"	0.202 (130.3)	2,160 (9.61)
3/4"	0.302 (194.8)	3,230 (14.37)
7/8"	0.419 (270.3)	4,480 (19.93)
1"	0.552 (356.1)	5,900 (26.24)

Threaded Rod Loads for Structural Applications (Based on AISC, Steel Construction Manual, ASD, 9th Edition. Per AISC, Allowed Tensile Stress = 0.33 * F <sub>u</sub> )		
Nominal Dia.	Nominal Area In <sup>2</sup> (mm <sup>2</sup> )	Allowed Tension Load Lbs (kN)
1/4"	0.049 (31.6)	930 (4.14)
3/8"	0.110 (71.0)	2,110 (9.39)
7/16"	0.150 (96.8)	2,870 (12.77)
1/2"	0.196 (126.5)	3,750 (16.68)
5/8"	0.307 (198.2)	5,870 (26.11)
3/4"	0.442 (285.4)	8,450 (37.59)
7/8"	0.601 (388.0)	11,500 (51.15)
1"	0.785 (506.8)	15,030 (66.86)

## STEEL COUPLER NUTS





Part Number	Size	Length In (mm)	Wt/100 pcs Lbs (kg)
HRCN025	1/4" - 20	7/8" (22.2)	1.9 (0.9)
HRCN031	5/16" - 18	1 1/4" (44.5)	7.5 (3.4)
HRCN037	3/8" - 16	1 1/4" (44.5)	9.0 (4.1)
HRCN044	7/16" - 14	1 1/4" (44.5)	10.4 (4.7)
HRCN050	1/2" - 13	1 1/4" (44.5)	10.0 (4.5)
HRCN062	5/8" - 11	2 1/8" (54.0)	18.0 (8.2)
HRCN075	3/4" - 10	2 1/4" (57.2)	28.0 (12.7)
HRCN087	7/8" - 9	2 1/2" (63.5)	55.0 (24.9)
HRCN100	1" - 8	2 3/4" (69.9)	73.0 (33.1)






### SLOT ADAPTER™




Part No.	Bolt Size	Wt/100 pcs Lbs (kg)
HOCW025	¼" (6.4)	1 (0.5)
HOCW037	⅜" (9.5)	1.5 (0.7)

### KWIK WASHER™





Overhead installation with one hand.  
Available in zinc plated and hot dip galvanized

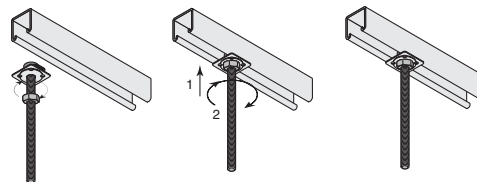

### P2486

### SEISMIC ROD STIFFENER

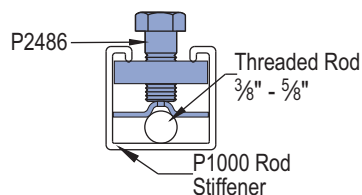


Wt/100 pcs: 16 Lbs (7.3 kg)


Part No.	Size In (mm)	Load Lbs (kN)	Wt/100 pcs Lbs (kg)
K1062	¼" (6.4)	250 (1.11)	1.2 (0.5)
K1063	⅜" (9.5)	610 (2.71)	2.6 (1.2)
K1064	½" (12.7)	1,130 (5.03)	9.3 (4.2)

### P2485

### CRADLE CLIP






Cradle clip only, order  
other items separately.



### P2485K

### SEISMIC CRADLE CLIP ASSEMBLY

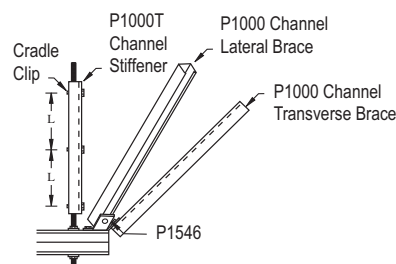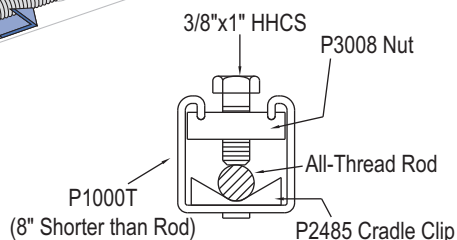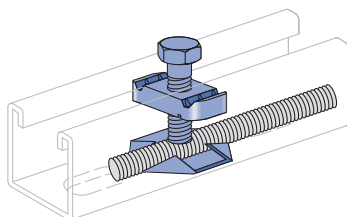

Wt/100 pcs: 3.0 Lbs (1.4 kg)


### P2485 & P2486 – SPACING CHART

.....Rod Stiffener Clip Spacing (L).....							
Rod Size In (mm)	Root Area In <sup>2</sup> (mm <sup>2</sup> )	Radius of Gyration In (mm)	Design Load Lbs (kN)	Rod Stress @100% 10,700 PSI In (mm)	Rod Stress @75% 8,025 PSI In (mm)	Rod Stress @50% 5,350 PSI In (mm)	Rod Stress @35% 3,745 PSI In (mm)
⅜	0.068	0.074	730	9	11	13	15
9.5	49.5	1.99	3.25	228.6	279.4	330.2	381.0
½	0.126	0.100	1,350	12	14	17	21
12.7	72.4	2.40	6.01	304.8	355.6	431.8	533.4
⅝	0.202	0.127	2,160	15	18	22	26
15.9	138.3	3.32	9.61	381.0	457.2	558.8	660.4

#### Notes:

- Minimum Tensile Stress is 50,000 psi (345MPa)
- Working Stress is 10,700 psi (73.9 MPa) – Same as for Tension
- Compression Will Only Occur During a Seismic Event
- Compression Requires the Use of Rod Stiffeners
- KL/r = 200 When Rod Stress is at 35%

Refer to seismic bracing systems catalog for more detailed information.



# CARUSO TURLEY SCOTT

structural engineers

1215 W. Rio Salado Parkway, Suite 200

Tempe, AZ 85281

480.774.1700

www.ctsaz.com

Job Name T-Mobile

16

Job No. \_\_\_\_\_ Sheet No. \_\_\_\_\_

By \_\_\_\_\_ Date \_\_\_\_\_

## Beam Supporting Digital Portals:

Beam Span = 31'-6"

- \* Beam spans between the existing demising wall and existing double wood trusses
- \* Beam will not positively attach to any trusses along the span such that it will not take any existing roof loads and will only take digital portal loads.

### Portal Loads:

- \* The portal is supported by (4) threaded rods:  $P_{rod} = 400\# \text{ portal} / 4 = 100\#$
- \* Beam takes the load from 1 threaded rod at 5 locations
- \* See Enercalc: **Use 3 1/2" x 11 7/8" Glulam Beam**

## Wood Beam

Project File: 241374 T Mobile.ec6

LIC# : KW-06016452, Build:20.24.06.04

CARUSO TURLEY SCOTT

(c) ENERCALC INC 1983-2023

**DESCRIPTION:** Beam Supporting Digital Portals

## CODE REFERENCES

Calculations per NDS 2018, IBC 2021, ASCE 7-16

Load Combination Set : IBC 2021


## Material Properties

Analysis Method : Allowable Stress Design  
Load Combination : IBC 2021

Wood Species : DF/DF  
Wood Grade : 24F-V4

Beam Bracing : Completely Unbraced

Fb +	2,400.0 psi	E : Modulus of Elasticity	
Fb -	1,850.0 psi	Ebend- xx	1,800.0ksi
Fc - Prll	1,650.0 psi	Eminbend - xx	950.0ksi
Fc - Perp	650.0 psi	Ebend- yy	1,600.0ksi
Fv	265.0 psi	Eminbend - yy	850.0ksi
Ft	1,100.0 psi	Density	31.210pcf

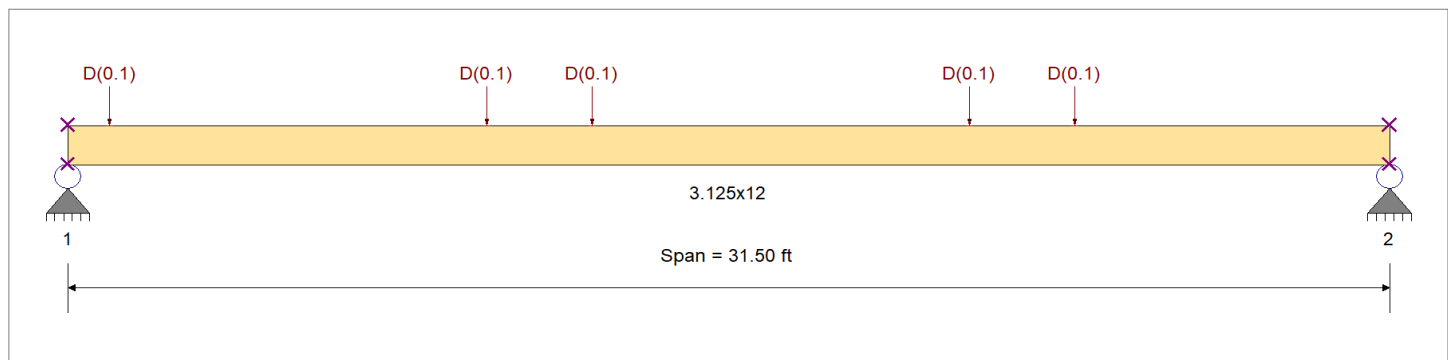

## Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight calculated and added to loading

Point Load : D = 0.10 k @ 1.0 ft  
Point Load : D = 0.10 k @ 10.0 ft  
Point Load : D = 0.10 k @ 12.5 ft  
Point Load : D = 0.10 k @ 21.5 ft  
Point Load : D = 0.10 k @ 24.0 ft

## DESIGN SUMMARY

**Design OK**

Maximum Bending Stress Ratio	=	<b>0.320</b> : 1	Maximum Shear Stress Ratio	=	<b>0.067</b> : 1
Section used for this span		<b>3.125x12</b>	Section used for this span		<b>3.125x12</b>
fb: Actual	=	492.86psi	fv: Actual	=	16.06 psi
F'b	=	1,539.47psi	F'v	=	238.50 psi
Load Combination	=	D Only	Load Combination	=	D Only
Location of maximum on span	=	13.451ft	Location of maximum on span	=	0.000 ft
Span # where maximum occurs	=	Span # 1	Span # where maximum occurs	=	Span # 1
<b>Maximum Deflection</b>					
Max Downward Transient Deflection	0 in	Ratio =	0 < 360	n/a	
Max Upward Transient Deflection	0 in	Ratio =	0 < 360	n/a	
Max Downward Total Deflection	0.691 in	Ratio =	547 >= 240	Span: 1 : D Only	
Max Upward Total Deflection	0 in	Ratio =	0 < 240	n/a	

## Maximum Forces & Stresses for Load Combinations

Load Combination		Max Stress Ratios										Moment Values			Shear Values		
Segment Length	Span #	M	V	CD	CM	C <sub>t</sub>	CLx	C <sub>y</sub>	Cfu	C <sub>i</sub>	C <sub>r</sub>	M	fb	F'b	V	fv	F'v
D Only														0.0	0.00	0.0	0.0
Length = 31.50 ft	1	0.320	0.067	0.90	1.00	1.00	0.71	1.000	1.00	1.00	1.00	3.08	492.9	1,539.5	0.40	16.1	238.5
+0.60D														0.0	0.00	0.0	0.0
Length = 31.50 ft	1	0.177	0.023	1.60	1.00	1.00	0.43	1.000	1.00	1.00	1.00	1.85	295.7	1,666.5	0.24	9.6	424.0

Wood Beam

Project File: 241374 T Mobile.ec6

LIC# : KW-06016452, Build:20.24.06.04 CARUSO TURLEY SCOTT (c) ENERCALC INC 1983-2023

DESCRIPTION: Beam Supporting Digital Portals


Overall Maximum Deflections

Load Combination	Span	Max. "-" Defl	Location in Span	Load Combination	Max. "+" Defl	Location in Span
D Only	1	0.6909	15.865		0.0000	0.000

Vertical Reactions

Support notation : Far left is #1 Values in KIPS

Load Combination	Support 1	Support 2
Max Upward from all Load Conditions	0.409	0.347
Max Upward from Load Combinations	0.245	0.208
Max Upward from Load Cases	0.409	0.347
D Only	0.409	0.347
+0.60D	0.245	0.208



# CARUSO TURLEY SCOTT

structural engineers

1215 W. Rio Salado Parkway, Suite 200

Tempe, AZ 85281

480.774.1700

www.clsaz.com

Job Name T-Mobile

19

Job No. \_\_\_\_\_ Sheet No. \_\_\_\_\_

By \_\_\_\_\_ Date \_\_\_\_\_

## New Beam at Existing Masonry Wall:

\* Use 12" deep ledger at masonry wall

Max Beam Rxcn at Ledger = 0.423 k<sub>DL</sub>

Worst Case LC: 1.2D = 0.5 k

\* Load is distributed to two anchors 24" O.C.


Shear per anchor = 0.5k / 2 anchors  
= 0.25k

e = .5(7.625") + 3.5" thick ledger  
= 7.3"

M = (0.5k / 2) \* 7.3"  
= 1.825 k-in

Tension per anchor = M/d = 1.825 k-in / (12"/2)  
= 0.3k

\* See Hilti Results: **Use (2) 3/4" epoxy threaded rods**

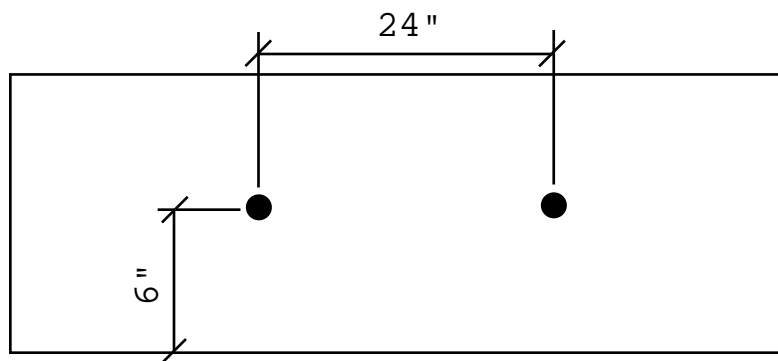

## Hilti PROFIS Engineering 3.1.5

www.hilti.com

Company:		Page:	1
Address:		Specifier:	
Phone   Fax:		E-Mail:	
Design:	Masonry - Nov 18, 2024	Date:	11/20/2024
Fastening point:			

Specifier's comments:

### 1 Input data



<b>Anchor type and diameter:</b>	<b>HY 270 + threaded rod 5.8 1/2</b>
Item number:	385424 HAS 5.8 1/2"x6-1/2" (element) / 2194247 HIT-HY 270 (adhesive)
Specification text:	Hilti HIT-V 5.8 threaded rod with HIT-HY 270 injection mortar with 4.5 in embedment hef, 1/2, Steel galvanized, Hammer drilled installation per instruction for use
Effective embedment depth:	$h_{ef} = 4.500$ in.
Material:	5.8
Evaluation Service Report:	Hilti Technical Data
Issued   Valid:	-   -
Proof:	Design Method ASD Masonry
Stand-off installation:	
Profile:	
Base material:	Grout-filled CMU, L x W x H: 16.000 in. x 8.000 in. x 8.000 in.; Joints: vertical: 0.375 in.; horizontal: 0.375 in. Base material temperature: 68 °F
Installation:	Face installation
Seismic loads	no

**Hilti PROFIS Engineering 3.1.5**[www.hilti.com](http://www.hilti.com)

Company:

Address:

Phone | Fax:

Design:

Fastening point:

Masonry - Nov 18, 2024

Page:


2

Specifier:

E-Mail:

Date:


11/20/2024

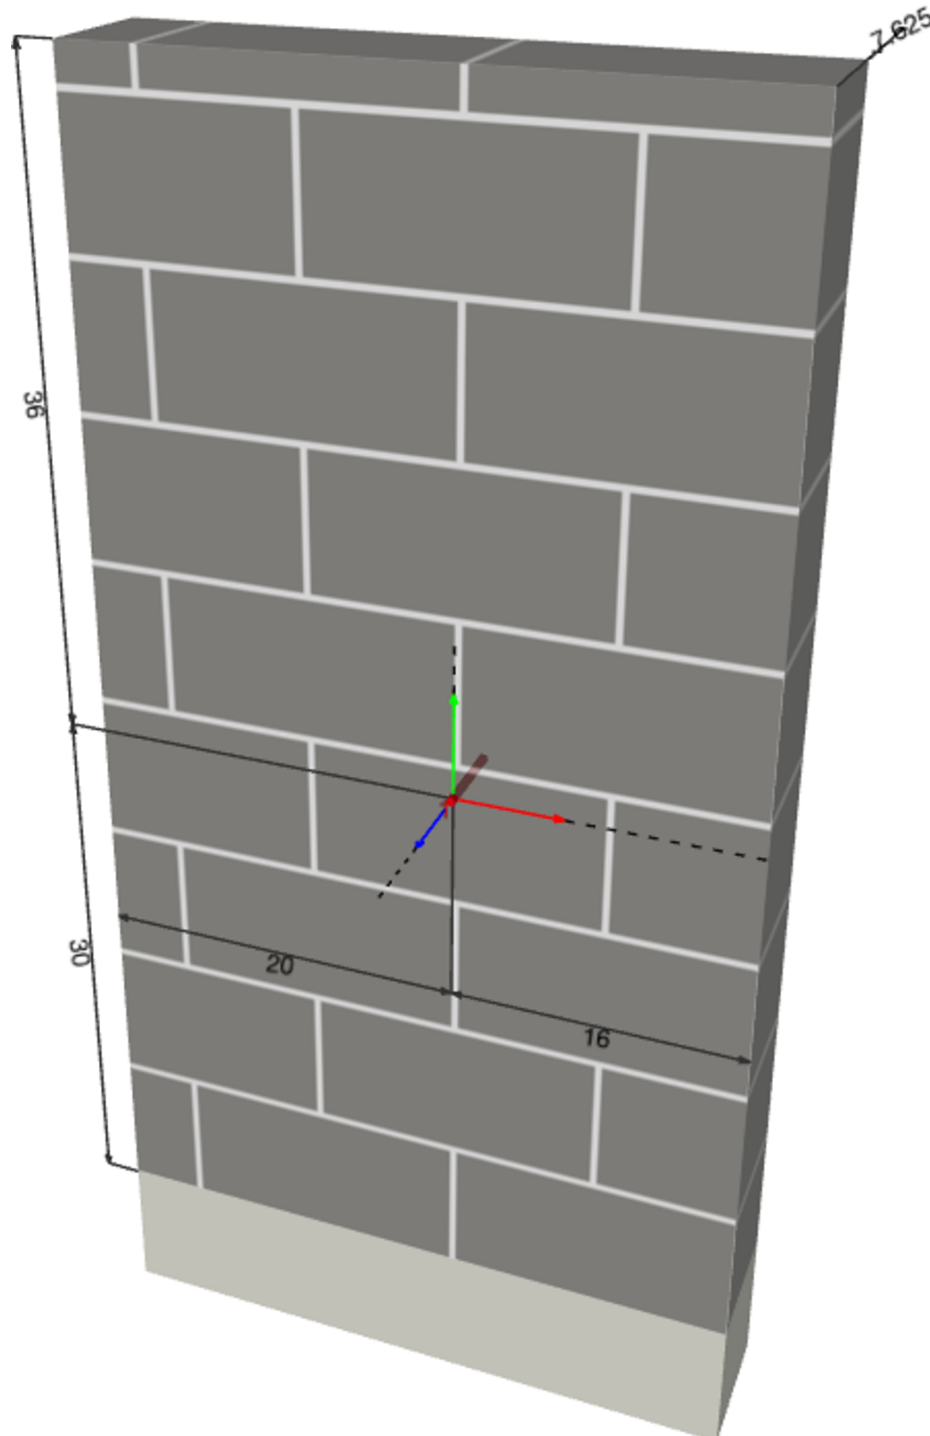**Geometry [in.]**

www.hilti.com

Company:		Page:	3
Address:		Specifier:	
Phone   Fax:		E-Mail:	
Design:	Masonry - Nov 18, 2024	Date:	11/20/2024
Fastening point:			

Geometry [in.] & Loading [lb, in.lb]

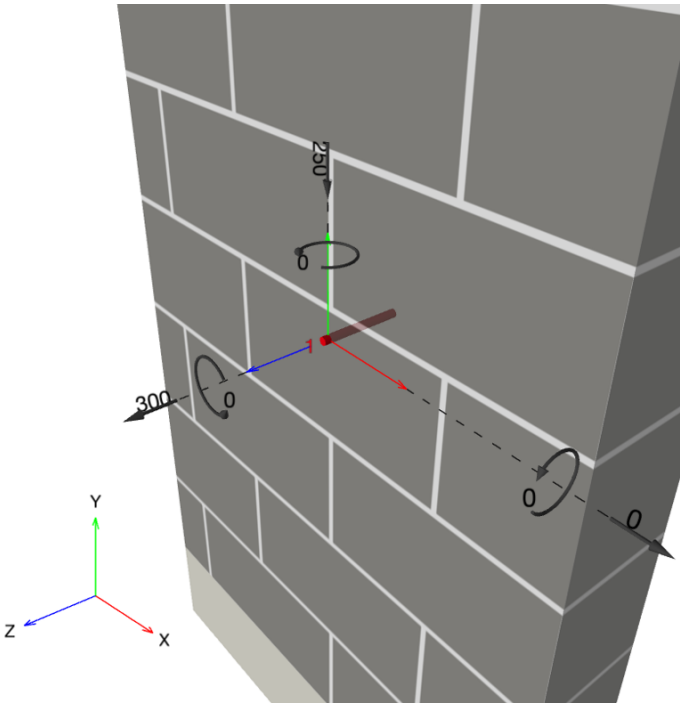

1.1 Design results

Case	Description	Forces [lb] / Moments [in.lb]	Seismic	Max. Util. Anchor [%]
1	Combination 1	N = 300; V <sub>x</sub> = 0; V <sub>y</sub> = -250; M <sub>x</sub> = 0; M <sub>y</sub> = 0; M <sub>z</sub> = 0;	no	17

2 Load case/Resulting anchor forces

Load case: Service loads

Anchor reactions [lb]

Tension force: (+Tension, -Compression)

Anchor	Tension force	Shear force	Shear force x	Shear force y
1	300	250	0	-250



Hilti PROFIS Engineering 3.1.5

www.hilti.com

Company:		Page:	4
Address:		Specifier:	
Phone   Fax:		E-Mail:	
Design:	Masonry - Nov 18, 2024	Date:	11/20/2024
Fastening point:			

3 Tension load (Most utilized anchor 1)

	Load $P_s$ [lb]	Capacity $P_t$ [lb]	Utilization $\beta_p = P_s/P_t$ [%]	Status
Steel strength	300	4,700	7	OK
Bond strength	300	1,913	16	OK

3.1 Steel strength

$P_{t,s}$  = Value refer to Hilti Technical Data  
 $P_{t,s} \geq P_s$

Results

$P_{t,s}$ [lb]	$P_s$ [lb]
4,700	300

3.2 Bond strength

$P_{t,b,Base}$  = Value refer to Hilti Technical Data  
 $P_{t,b} = P_{t,b,Base} \cdot f_{red,E} \cdot f_{red,s} \cdot f_{red,Temp} \cdot f_{red,Bedjoint}$   
 $P_{t,b} \geq P_s$

Variables

$c_{min}$ [in.]	$c_{cr}$ [in.]	$s_{min}$ [in.]	$s_{cr}$ [in.]	Temperature [°F]
4.000	20.000	4.000	18.000	68

Results

$P_{t,b}$ [lb]	$P_{t,b,Base}$ [lb]	$P_s$ [lb]	$f_{red,E}$	$f_{red,S}$	$f_{red,Temp}$	$f_{red,Bedjoint}$
1,913	2,035	300	0.940	1.000	1.000	1.000



## Hilti PROFIS Engineering 3.1.5

www.hilti.com

Company:

Address:

Phone | Fax:

Design:

Fastening point:

Masonry - Nov 18, 2024

Page:

Specifier:

E-Mail:

Date:

5

11/20/2024

### 4 Shear load (Most utilized anchor 1)

	Load $V_s$ [lb]	Capacity $V_t$ [lb]	Utilization $\beta_V = V_s/V_t$ [%]	Status
Steel strength	250	2,420	11	OK
Bond strength para and perp, (Dir. x-) <sup>1</sup>	-	-	17	OK

<sup>1</sup>Shear utilization may result from parallel and perpendicular shear (see details)

#### 4.1 Steel strength

$V_{t,s}$  = Value refer to Hilti Technical Data

$V_{t,s} \geq V_s$

Results

$V_{t,s}$ [lb]	$V_s$ [lb]
2,420	250

#### 4.2 Bond strength parallel

$V_{t,b,Base,||}$  = Value refer to Hilti Technical Data

$V_{t,b,||} = V_{t,b,Base,||} \cdot f_{red,E,||} \cdot f_{red,s,||} \cdot f_{red,Temp}$

$V_{t,b,||} \geq V_{s,||}$

Variables

$c_{min}$ [in.]	$c_{cr}$ [in.]	$s_{min}$ [in.]	$s_{cr}$ [in.]	Temperature [°F]
4.000	12.000	4.000	18.000	68

Results

$V_{t,b,  }$ [lb]	$V_{t,b,Base,  }$ [lb]	$V_{s,  }$ [lb]	$f_{red,E,  }$	$f_{red,s,  }$	$f_{red,Temp}$	Utilization $\beta_{V,  }$ [%]
1,495	1,495	-250	1.000	1.000	1.000	17

#### 4.3 Bond strength perpendicular

$V_{t,b,Base,\perp}$  = Value refer to Hilti Technical Data

$V_{t,b,\perp} = V_{t,b,Base,\perp} \cdot f_{red,E,\perp} \cdot f_{red,s,\perp} \cdot f_{red,Temp}$

$V_{t,b,\perp} \geq V_{s,\perp}$

Variables

$c_{min}$ [in.]	$c_{cr}$ [in.]	$s_{min}$ [in.]	$s_{cr}$ [in.]	Temperature [°F]
4.000	12.000	4.000	18.000	68

Results

$V_{t,b,\perp}$ [lb]	$V_{t,b,Base,\perp}$ [lb]	$V_{s,\perp}$ [lb]	$f_{red,E,\perp}$	$f_{red,s,\perp}$	$f_{red,Temp}$	Utilization $\beta_{V,\perp}$ [%]
0	1,495	0	0.000	0.000	1.000	0



## Hilti PROFIS Engineering 3.1.5

www.hilti.com

Company:		Page:	6
Address:		Specifier:	
Phone   Fax:		E-Mail:	
Design:	Masonry - Nov 18, 2024	Date:	11/20/2024
Fastening point:			

### 4.4 Shear interaction

$\beta_{V,\parallel} = \frac{V_{s,\parallel}}{V_{t,\parallel}}$	$\beta_{V,\perp} = \frac{V_{s,\perp}}{V_{t,\perp}}$	$\delta$	Utilization $\beta_V$ [%]	Status
0.167	0.000	1.667	17	OK

$$\beta_V = \beta_{V,\parallel}^{\delta} + \beta_{V,\perp}^{\delta} \leq 1.0$$

### 5 Combined tension and shear loads (Most utilized anchor 1)

$\beta_P = \frac{P_s}{P_t}$	$\beta_{V,\parallel} = \frac{V_{s,\parallel}}{V_{t,\parallel}}$	$\beta_{V,\perp} = \frac{V_{s,\perp}}{V_{t,\perp}}$	$\alpha$	Utilization $\beta_{P,V}$ [%]	Status
0.046	0.167	0.000	1.667	10	OK

$$\beta_{P,V} = \beta_P^{\alpha} + \beta_{V,\parallel}^{\alpha} + \beta_{V,\perp}^{\alpha} \leq 1.0$$

### 6 Warnings

- The anchor design methods in PROFIS Engineering require rigid anchor plates per current regulations (AS 5216:2021, ETAG 001/Annex C, EOTA TR029 etc.). This means load re-distribution on the anchors due to elastic deformations of the anchor plate are not considered - the anchor plate is assumed to be sufficiently stiff, in order not to be deformed when subjected to the design loading. PROFIS Engineering calculates the minimum required anchor plate thickness with CBFEM to limit the stress of the anchor plate based on the assumptions explained above. The proof if the rigid anchor plate assumption is valid is not carried out by PROFIS Engineering. Input data and results must be checked for agreement with the existing conditions and for plausibility!
- Refer to the manufacturer's product literature for cleaning and installation instructions.
- For additional information about ACI 318 strength design provisions, please go to <https://submittals.us.hilti.com/PROFISAnchorDesignGuide/>
- The min. sizes of the bricks, the masonry compressive strength, the type / strength of the mortar and the grout (in case of fully grouted CMU walls) has to fulfill the requirements given in the relevant ESR-approval or in the PTG.
- Only the local load transfer from the anchor(s) to the wall is considered, a further load transfer in the wall is not covered by PROFIS!
- Wall is assumed as being perfectly aligned vertically – checking required(!): Noncompliance can lead to significantly different distribution of forces and higher tension loads than those calculated by PROFIS. Masonry wall must not have any damages (neither visible nor not visible)! While installation, the positioning of the anchors needs to be maintained as in the design phase i.e. either relative to the brick or relative to the mortar joints.
- The effect of the joints on the compressive stress distribution on the plate / bricks was not taken into consideration.
- If no significant resistance is felt over the entire depth of the hole when drilling (e.g. in unfilled butt joints), the anchor should not be set at this position or the area should be assessed and reinforced. Hilti recommends the anchoring in masonry always with sieve sleeve. Anchors can only be installed without sieve sleeves in solid bricks when it is guaranteed that it has not any hole or void.
- The accessories and installation remarks listed on this report are for the information of the user only. In any case, the instructions for use provided with the product have to be followed to ensure a proper installation.
- The compliance with current standards (e.g. 2018, 2015, 2012, 2009 and 2006 IBC) is the responsibility of the user.
- Drilling method (hammer, rotary) to be in accordance with the approval!
- Masonry needs to be built in a regular way in accordance with state-of the art guidelines!

**Fastening meets the design criteria!**

## Hilti PROFIS Engineering 3.1.5

www.hilti.com

Company:		Page:	7
Address:		Specifier:	
Phone   Fax:		E-Mail:	
Design:	Masonry - Nov 18, 2024	Date:	11/20/2024
Fastening point:			

### 7 Installation data

Profile: -

Hole diameter in the fixture: -

Plate thickness (input): -

Drilling method: Drilled in hammer mode

Anchor type and diameter: HY 270 + threaded rod 5.8 1/2

Item number: 385424 HAS 5.8 1/2"x6-1/2" (element) /

2194247 HIT-HY 270 (adhesive)

Maximum installation torque: 90 in.lb

Hole diameter in the base material: 0.562 in.

Hole depth in the base material: 4.500 in.

Minimum thickness of the base material: 7.625 in.

Hilti HIT-V 5.8 threaded rod with HIT-HY 270 injection mortar with 4.5 in embedment hef, 1/2, Steel galvanized, Hammer drilled installation per instruction for use

#### Coordinates Anchor in.

Anchor	x	y	c <sub>-x</sub>	c <sub>+x</sub>	c <sub>-y</sub>	c <sub>+y</sub>
1	0.000	0.000	20.000	16.000	30.000	36.000

---


**Hilti PROFIS Engineering 3.1.5****www.hilti.com**

Company:		Page:	8
Address:		Specifier:	
Phone   Fax:		E-Mail:	
Design:	Masonry - Nov 18, 2024	Date:	11/20/2024
Fastening point:			

---

**8 Remarks; Your Cooperation Duties**

- Any and all information and data contained in the Software concern solely the use of Hilti products and are based on the principles, formulas and security regulations in accordance with Hilti's technical directions and operating, mounting and assembly instructions, etc., that must be strictly complied with by the user. All figures contained therein are average figures, and therefore use-specific tests are to be conducted prior to using the relevant Hilti product. The results of the calculations carried out by means of the Software are based essentially on the data you put in. Therefore, you bear the sole responsibility for the absence of errors, the completeness and the relevance of the data to be put in by you. Moreover, you bear sole responsibility for having the results of the calculation checked and cleared by an expert, particularly with regard to compliance with applicable norms and permits, prior to using them for your specific facility. The Software serves only as an aid to interpret norms and permits without any guarantee as to the absence of errors, the correctness and the relevance of the results or suitability for a specific application.
- You must take all necessary and reasonable steps to prevent or limit damage caused by the Software. In particular, you must arrange for the regular backup of programs and data and, if applicable, carry out the updates of the Software offered by Hilti on a regular basis. If you do not use the AutoUpdate function of the Software, you must ensure that you are using the current and thus up-to-date version of the Software in each case by carrying out manual updates via the Hilti Website. Hilti will not be liable for consequences, such as the recovery of lost or damaged data or programs, arising from a culpable breach of duty by you.



# CARUSO TURLEY SCOTT

structural engineers

1215 W. Rio Salado Parkway, Suite 200

Tempe, AZ 85281

480.774.1700

www.ctsaz.com

Job Name T-Mobile

28

Job No. \_\_\_\_\_ Sheet No. \_\_\_\_\_

By \_\_\_\_\_ Date \_\_\_\_\_

## New Beam at Existing Double Wood Trusses:


Max Beam Rxcn = 420 lb


\*Use Simpson THG3.62-SDS hanger

Hanger capacity = 6310 lb > 420 lb **OKAY**

### NOTES:

1. EXISTING PLYWOOD SHEATHING
2. EXISTING DOUBLE WOOD TRUSS
3. WOOD BEAM PER PLAN
4. SIMPSON THGQ3.62-SDS HANGER. FILL ALL HOLES WITH 1/4" x 3" SDS SCREWS
5. 2x10 FLAT WITH (4) 10d x 3" LONG NAILS AT TOP AND BOTTOM CHORD

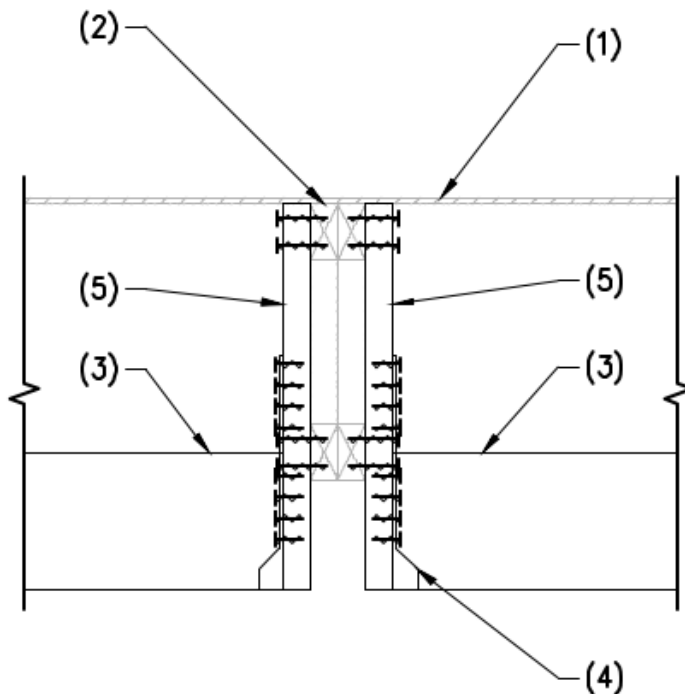



# CARUSO TURLEY SCOTT

structural engineers

1215 W. Rio Salado Parkway, Suite 200

Tempe, AZ 85281

480.774.1700

www.ctsaz.com

Job Name T-Mobile

29

Job No. \_\_\_\_\_ Sheet No. \_\_\_\_\_

By \_\_\_\_\_ Date \_\_\_\_\_

## New Beam at Existing Steel Stud Wall:


Max Beam Rxcn = 423 lb

\* Try bearing beam on 4x4 wood post

\* See Enercalc Results: **Use 4X4 wood post**

### NOTES:

1. WOOD BEAM PER PLAN
2. SIMPSON ACH4Z POST CAP.  
FILL ALL HOLES WITH -.162 x  
2 1/2" SCREWS.
3. EXISTING STEEL STUD WALL.
4. 4x4 WOOD POST.
5. 600S125-33 STUD BLOCKING  
EACH SIDE OF WOOD BEAM.  
USE SIMPSON L50 CLIPS TO  
ATTACH BLOCKING TO STUDS  
AND BEAM.
6. SEE DETAIL 16 FOR POST  
BOTTOM CONNECTION

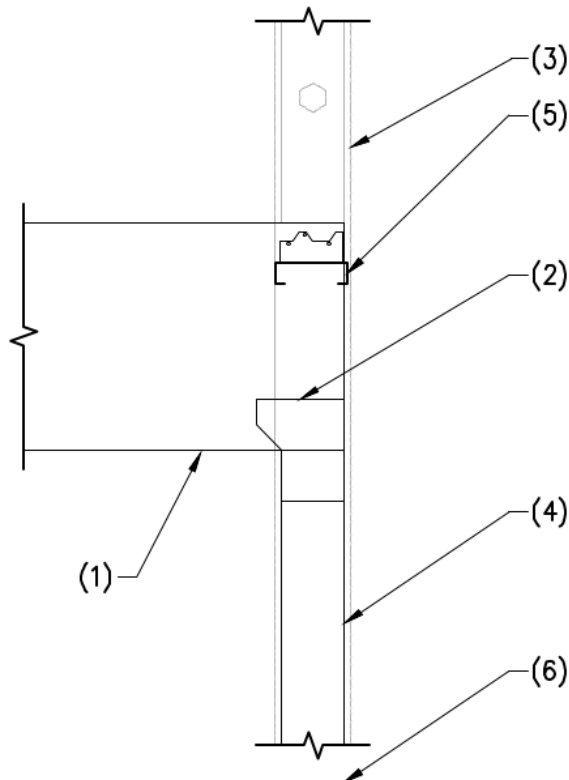

15

WOOD BEAM AT STEEL STUD WALL

24-1265

NO SCALE

## Wood Column

Project File: 241374 T Mobile.ec6

LIC# : KW-06016452, Build:20.24.06.04

CARUSO TURLEY SCOTT

(c) ENERCALC INC 1983-2023

**DESCRIPTION:** Wood Post

### Code References

Calculations per NDS 2018, IBC 2021, ASCE 7-16  
Load Combinations Used : IBC 2021

### General Information

Analysis Method	Allowable Stress Design			Wood Section Name	4x4	
End Fixities	Top & Bottom Pinned			Wood Grading/Manuf.	Graded Lumber	
Overall Column Height	11 ft			Wood Member Type	Sawn	
( Used for non-slender calculations )						
Wood Species	Douglas Fir-Larch			Exact Width	3.50 in	Allow Stress Modification Factors
Wood Grade	No.2			Exact Depth	3.50 in	Cf or Cv for Bending 1.50
Fb +	900.0 psi	Fv	180.0 psi	Area	12.250 in^2	Cf or Cv for Compression 1.150
Fb -	900.0 psi	Ft	575.0 psi	Ix	12.505 in^4	Cf or Cv for Tension 1.50
Fc - Prll	1,350.0 psi	Density	31.210 pcf	Iy	12.505 in^4	Cm : Wet Use Factor 1.0
Fc - Perp	625.0 psi					Ct : Temperature Fact 1.0
E : Modulus of Elasticity . . .	x-x Bending	y-y Bending	Axial			Cfu : Flat Use Factor 1.0
	Basic	1,600.0	1,600.0	1,600.0 ksi		Kf : Built-up columns 1.0
	Minimum	580.0	580.0			Use Cr : Repetitive ? No
Column Buckling Condition:						
ABOUT X-X Axis: Lux = 11 ft, Kx = 1.0						
ABOUT Y-Y Axis: Luy = 11 ft, Ky = 1.0						

### Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Column self weight included : 29.205 lbs \* Dead Load Factor

AXIAL LOADS . . .

Axial Load at 11.0 ft, Xecc = 2.0 in, D = 0.4230 k

### DESIGN SUMMARY

#### Bending & Shear Check Results

**PASS** Max. Axial+Bending Stress Ratio = **0.1224 : 1**  
 Load Combination D Only  
 Governing NDS Formula Comp + Myy, NDS Eq. 3.9-3  
 Location of max.above base 10.926 ft  
 At maximum location values are .  
 Applied Axial 0.4522 k  
 Applied Mx 0.0 k-ft  
 Applied My -0.07003 k-ft  
 Fc : Allowable 316.632 psi

**Maximum SERVICE Lateral Load Reactions . .**  
 Top along Y-Y 0.0 k Bottom along Y-Y 0.0 k  
 Top along X-X 0.006409 k Bottom along X-X 0.006409 k

**Maximum SERVICE Load Lateral Deflections . . .**  
 Along Y-Y 0.0 in at 0.0 ft above base  
 for load combination : n/a  
 Along X-X -0.04767 in at 6.423 ft above base  
 for load combination : D Only

**PASS** Maximum Shear Stress Ratio = **0.004844 : 1**  
 Load Combination D Only  
 Location of max.above base 11.0 ft  
 Applied Design Shear 1.177 psi  
 Allowable Shear 162.0 psi

**Other Factors used to calculate allowable stresses . . .**  
 Bending Compression Tension

### Load Combination Results

Load Combination	C <sub>D</sub>	C <sub>P</sub>	Maximum Axial + Bending Stress Ratios			Maximum Shear Ratios		
			Stress Ratio	Status	Location	Stress Ratio	Status	Location
D Only	0.900	0.227	0.1224	PASS	10.926 ft	0.004844	PASS	11.0 ft
+0.60D	1.600	0.131	0.06807	PASS	0.0 ft	0.001635	PASS	11.0 ft

### Maximum Reactions

Note: Only non-zero reactions are listed.

Load Combination	X-X Axis Reaction		k	Y-Y Axis Reaction		Axial Reaction	My - End Moments		k-ft Mx - End Moments	
	@ Base	@ Top		@ Base	@ Top		@ Base	@ Top	@ Base	@ Top
D Only	-0.006	0.006				0.452				
+0.60D	-0.004	0.004				0.271				



Wood Column

Project File: 241374 T Mobile.ec6

LIC# : KW-06016452, Build:20.24.06.04

CARUSO TURLEY SCOTT


(c) ENERCALC INC 1983-2023


DESCRIPTION: Wood Post

Maximum Deflections for Load Combinations

Load Combination	Max. X-X Deflection	Distance	Max. Y-Y Deflection	Distance
D Only	-0.0477 in	6.423ft	0.000 in	0.000 ft
+0.60D	-0.0286 in	6.423ft	0.000 in	0.000 ft

Sketches

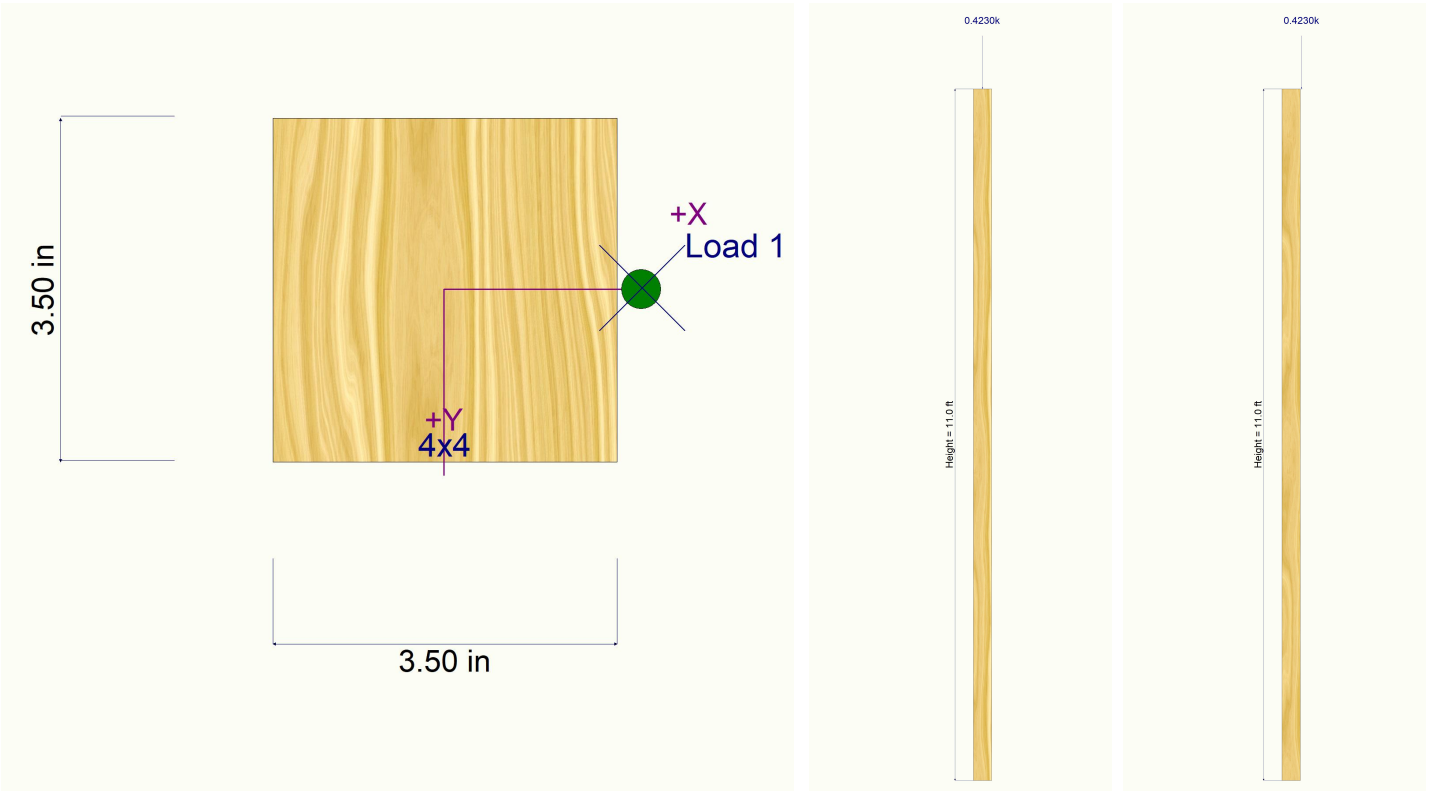



# CARUSO TURLEY SCOTT

structural engineers

1215 W. Rio Salado Parkway, Suite 200

Tempe, AZ 85281

480.774.1700

www.clsaz.com

32

Job Name T-Mobile

\_\_\_\_\_

\_\_\_\_\_

Job No. \_\_\_\_\_ Sheet No. \_\_\_\_\_

By \_\_\_\_\_ Date \_\_\_\_\_

## New Mechanical Unit:

\* A 5 ton mechanical unit will replace the existing 5 ton mechanical unit and will rest on the existing curb to remain

\* Since the new mechanical unit will be the same size as the existing mechanical unit, it is acceptable to load the existing wood trusses with the new mechanical unit.

\* See the following pages for the mechanical unit anchorage to the existing curb and existing trusses subject to wind loads.



# CARUSO TURLEY SCOTT

## structural engineers

1215 W. Rio Salado Parkway, Suite 200  
Tempe, Arizona 85281  
T: 480 774-1700 F: 480 774-1701  
www.ctsoz.com

Job Name: T-Mobile TI  
Job No.: 24-1374 Sheet No.: 33  
By: JKC Date: Nov-24

### MECHANICAL UNIT OVERTURNING: RECTANGULAR BASE WITH NO LEGS

ASCE 7-16 / 7-10

#### Unit info:

Weight=	955	lb X 1.2=	1146	lb	Effective Dimensions used to calculate $A_f$
Length=	94	in			Effective Length= 94.0 in
Width=	56	in			Effective Width= 56.0 in
Height=	48	in			Effective Height= 48.0 in
Curb height =	12	in			Height to CGS of unit= 36.0 in

Seismic: Per ASCE 7 Chapter 13

$S_{DS}$ =	1.008		
$a_p$ =	2.5	$I_p$ =	1
$R_p$ =	6	$z/h$ =	1 (conservative)

$$F_p = \frac{(4 \cdot a_p \cdot S_{ds} \cdot W)}{R_p \cdot I_p} = 0.504 \quad W \quad < \text{--- Governs}$$

$$F_{p \text{ MAX}} = 1.6 \cdot S_{DS} \cdot I_p \cdot W = 1.613 \quad W$$

$$F_{p \text{ MIN}} = .3 \cdot S_{DS} \cdot I_p \cdot W = 0.302 \quad W$$

$$F_{V \text{ SEISMIC}} = 193 \pm 0.2 S_{DS} W_p$$

\*included in  $M_{OT(BASE)}$  and  $M_{OT(CURB)}$

$$F_p = 481 \quad \text{lb @} \quad 36 \quad \text{in}$$

$$M_{OT(BASE)} = 22718 \quad \text{in} \cdot \text{lb} \cdot 0.7 = 15902.8 \quad \text{in} \cdot \text{lb}$$

$$M_R = 26740 \quad \text{in} \cdot \text{lb} \cdot 0.6 = 16044.0 \quad \text{in} \cdot \text{lb}$$

$$T_{(BASE)} = -3 \quad \text{lb} \quad \text{*Tension is +}$$

$$M_{OT(CURB)} = 16942 \quad \text{in} \cdot \text{lb} \cdot .7 = 11859.7 \quad \text{in} \cdot \text{lb}$$

$$M_R = \text{Weight} \cdot \text{Width}/2$$

$$T_{(CURB)} = -75 \quad \text{lb} \quad \text{*Tension is +}$$

$$\text{Sliding: } V = 481 \quad \text{lb} \cdot 0.7 = 337 \quad \text{lb}$$

#### Wind:

110	mph 3- sec gust wind speed	Risk Category	II
Exposure	C		

$$A_f = 39 \quad \text{ft}^2 \quad A_v = 37 \quad \text{ft}^2$$

$$A_f < 0.1 B h \text{ therefore } G_{Cr}(h) = 1.9$$

$$G_{Cr}(v) = 1.5$$

$$K_z = 0.95 \quad K_{zt} = 1.0 \quad K_d = 0.85 \quad K_e = 1.00$$

$$q_z = 0.00256 K_z K_{zt} K_d V^2 = 24.9 \quad \text{psf} \quad \text{ASCE 7-16 Eqn 26.10-1 / 7-10 Eqn 30.3-1}$$

$$F_h = q_h(G_{Cr}) A_f = 1852 \quad \text{lbs} \quad \text{ASCE-7 Eqn 29.5-2}$$

$$F_v = q_v(G_{Cr}) A_v = 1365 \quad \text{lbs} \quad \text{ASC\&-7 Eqn 29.5-3}$$

$$M_{OT(BASE)} = 104888 \quad \text{in} \cdot \text{lb} \cdot 0.6 = 62933 \quad \text{in} \cdot \text{lb}$$

$$M_R = 26740 \quad \text{in} \cdot \text{lb} \cdot 0.6 = 16044 \quad \text{in} \cdot \text{lb}$$

$$T_{(BASE)} = 837 \quad \text{lb} \quad \text{*Tension is +}$$

$$M_{OT(CURB)} = 82663 \quad \text{in} \cdot \text{lb} \cdot 0.6 = 49598 \quad \text{in} \cdot \text{lb}$$

$$M_R = \text{Weight} \cdot \text{Width}/2$$

$$T_{(CURB)} = 599 \quad \text{lb} \quad \text{*Tension is +}$$

$$\text{Sliding: } V = 1852 \quad \text{lb} \cdot .6 = 1111 \quad \text{lb}$$

Template Updated 09/09/20



# CARUSO TURLEY SCOTT structural engineers

1215 W. Rio Salado Parkway, Suite 200  
Tempe, Arizona 85281  
T: 480 774-1700 F: 480 774-1701  
www.ctsoz.com

Job Name: T-Mobile TI  
Job No.: 24-1374 Sheet No.: 34  
By: JKC Date: Nov-24

Attachment of Mechanical unit to curb:

Screw spacing unit to curb:

#12 screw spacing = 12 in o.c.

$V_{MAX} = 1111$  lb

$N = 25$  screws

$V_{ALLOW/SCREW}$  (20 gage material) = 188 lb


$V_{ALLOW} = 4700$  lb OK

$T_{MAX} = 599$  lb

$N = 8$  screws

$T_{ALLOW/SCREW}$  (20 gage material) = 95 lb

$T_{ALLOW} = 760$  lb OK

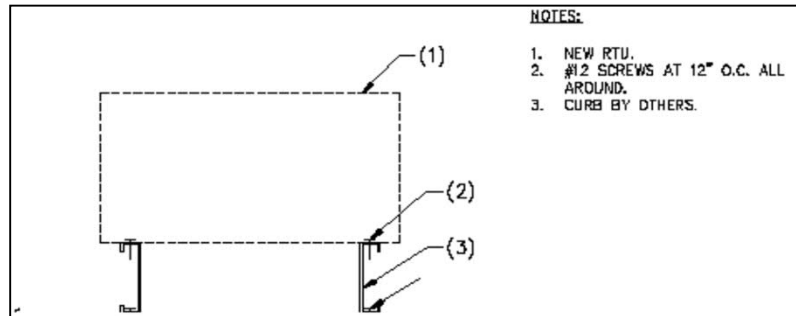

Seismic  
Unity  $\frac{V_{ACTUAL}}{V_{ALLOW}} = \frac{337}{4700} + \frac{T_{ACTUAL}}{T_{ALLOW}} = \frac{0}{760} = 0.07$  OK

Wind  
Unity  $\frac{V_{ACTUAL}}{V_{ALLOW}} = \frac{1111}{4700} + \frac{T_{ACTUAL}}{T_{ALLOW}} = \frac{599}{760} = 1.02$  NG

Allowable Screw Connection Capacity (lbs)																		
Thickness (Mils)	Design Thickness	Fy Yield (ksi)	Fu Tensile (ksi)	#8 Screw (Psc = 843 lbs, Pts = 416 lbs)			#8 Screw (Psc = 1278 lbs, Pts = 688 lbs)			#10 Screw (Psc = 1844 lbs, Pts = 1158 lbs)			#12 Screw (Psc = 2330 lbs, Pts = 2325 lbs)			1/4" Screw (Psc = 3048 lbs, Pts = 3291 lbs)		
				0.136" dia, 0.272" Head			0.164" dia, 0.272" Head			0.190" dia, 0.340" Head			0.218" dia, 0.340" Head			0.250" dia, 0.406" Head		
				Shear	Pull-Out	Pull-Over	Shear	Pull-Out	Pull-Over	Shear	Pull-Out	Pull-Over	Shear	Pull-Out	Pull-Over	Shear	Pull-Out	Pull-Over
18	0.0188	33	33	44	24	84	48	29	84	52	33	105	55	38	105	60	44	127
27	0.0283	33	33	82	37	127	89	43	127	96	50	159	102	57	159	110	66	191
30	0.0312	33	33	95	40	140	103	48	140	111	55	175	118	63	175	127	73	211
33	0.0346	33	45	151	81	140	164	72	105	177	84	285	188	95	285	203	110	318
43	0.0451	33	45	214	79	140	244	94	195	263	109	345	280	134	345	302	144	415
54	0.0586	33	45	214	100	140	344	118	195	370	137	386	394	156	433	424	180	521
66	0.0713	33	45	214	125	140	426	149	195	523	173	386	557	196	545	600	227	658
97	0.1017	33	45	214	140	140	426	195	195	548	248	386	777	280	775	1,016	324	938
118	0.1262	33	45	214	140	140	426	195	195	548	301	386	777	342	775	1,016	389	1,067
54	0.0586	50	65	214	140	140	426	171	195	534	198	386	569	225	625	613	261	752
66	0.0713	50	65	214	140	140	426	195	195	548	249	386	777	284	775	666	328	948
97	0.1017	50	65	214	140	140	426	195	195	548	358	386	777	405	775	1,016	468	1,067
118	0.1262	50	65	214	140	140	426	195	195	548	386	386	777	494	775	1,016	572	1,067

Template Updated 09/09/20



# CARUSO TURLEY SCOTT structural engineers

1215 W. Rio Salado Parkway, Suite 200  
Tempe, Arizona 85281  
T: 480 774-1700 F: 480 774-1701  
www.ctsoz.com

Job Name: T-Mobile TI  
Job No.: 24-1374 Sheet No.: 35  
By: JKC Date: Nov-24

## Attachment of curb to wood framing:

Screw spacing curb to wood:

#12 screw spacing = 12 in o.c.

x 2 1/2" long wood screws

$V_{MAX} = 1111$  lb

N= 25 screws

$V_{ALLOW/SCREW} = 228$  lb


$V_{ALLOW} = 5700$  lb OK

$T_{MAX} = 837$  lb

N= 8 screws

$T_{ALLOW/SCREW} = 410$  lb

$T_{ALLOW} = 3280$  lb OK

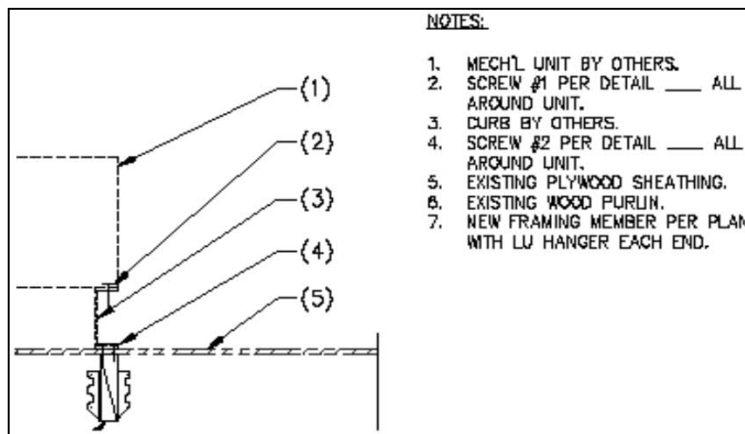

Seismic Unity  $\frac{V_{ACTUAL}}{V_{ALLOW}} = \frac{337}{5700} + \frac{T_{ACTUAL}}{T_{ALLOW}} = \frac{0}{3280} = 0.06$  OK

Wind Unity  $\frac{V_{ACTUAL}}{V_{ALLOW}} = \frac{1111}{5700} + \frac{T_{ACTUAL}}{T_{ALLOW}} = \frac{599}{3280} = 0.38$  OK

Allowable Screw Connection Capacity (lbs)																		
Thickness (Mil)	Design Thickness	Fy Yield (ksi)	Fu Tensile (ksi)	#8 Screw (Pec = 843 lbs, Pts = 419 lbs)			#8 Screw (Pec = 1278 lbs, Pts = 688 lbs)			#10 Screw (Pec = 1844 lbs, Pts = 1158 lbs)			#12 Screw (Pec = 2330 lbs, Pts = 2325 lbs)			1/4" Screw (Pec = 3048 lbs, Pts = 3281 lbs)		
				0.138" dia, 0.272" Head			0.164" dia, 0.272" Head			0.190" dia, 0.340" Head			0.218" dia, 0.340" Head			0.250" dia, 0.406" Head		
				Shear	Pull-Out	Pull-Over	Shear	Pull-Out	Pull-Over	Shear	Pull-Out	Pull-Over	Shear	Pull-Out	Pull-Over	Shear	Pull-Out	Pull-Over
18	0.0188	33	33	44	34	84	48	29	84	52	33	105	55	38	105	60	44	127
27	0.0283	33	33	82	37	127	89	43	127	96	50	159	102	57	159	110	66	191
30	0.0312	33	33	95	40	140	103	48	140	111	55	175	118	63	175	127	73	211
33	0.0348	33	45	151	61	140	164	72	105	177	64	265	188	95	265	203	110	318
43	0.0451	33	45	214	79	140	244	94	195	263	109	345	280	134	345	302	144	415
54	0.0586	33	45	214	100	140	344	118	195	370	137	386	394	156	433	424	180	521
66	0.0713	33	45	214	125	140	426	149	195	523	173	386	557	196	545	600	227	656
97	0.1017	33	45	214	140	140	426	195	195	548	248	386	777	280	775	1,016	304	936
118	0.1242	33	45	214	140	140	426	195	195	548	301	386	777	342	775	1,016	386	1,087
54	0.0586	50	65	214	140	140	426	171	195	534	198	386	599	225	625	613	261	752
66	0.0713	50	65	214	140	140	426	195	195	548	249	386	777	284	775	886	328	948
97	0.1017	50	65	214	140	140	426	195	195	548	356	386	777	405	775	1,016	468	1,087
118	0.1242	50	65	214	140	140	426	195	195	548	386	386	777	494	775	1,016	572	1,087



# CARUSO TURLEY SCOTT

## structural engineers

1215 W. Rio Salado Parkway, Suite 200  
Tempe, Arizona 85281  
T: 480 774-1700 F: 480 774-1701  
www.ctsoz.com

Job Name: T-Mobile TI  
Job No.: 24-1374 Sheet No.: 36  
By: JKC Date: Nov-24

Connection Calculator

<https://www.awc.org/codes-standards/calculators-software/connectioncalc>

Design Method	Allowable Stress Design (ASD)
Connection Type	Withdrawal loading
Fastener Type	Wood Screw
Loading Scenario	N/A
<input type="button" value="Submit Initial Values"/>	

Main Member Type	Douglas Fir-Larch
Main Member Thickness	3.5 in.
Side Member Type	Steel
Side Member Thickness	20 gage
Wood Screw Number	12 (D = 0.216 in.)
Length	2.5 in.
Load Duration Factor	C <sub>D</sub> = 1.6
Wet Service Factor	C <sub>M</sub> = 1.0
Temperature Factor	C <sub>t</sub> = 1.0

### Calculate Connection Capacity

<a href="#">Connection Yield Mode Descriptions</a>	<a href="#">Limits of Use</a>
<a href="#">Diaphragm Factor Help</a>	<a href="#">Load Duration Factor Help</a>
<a href="#">Show Printable View</a>	<a href="#">Technical Help</a>

Adjusted ASD Capacity	410 lbs.
-----------------------	----------

- The Adjusted ASD Capacity does not apply for wood screws installed in the end grain of wood members.
- The Adjusted ASD Capacity only applies to withdrawal of the fastener from the main member. It does not address head pull capacity of the fastener in the side member.

While every effort has been made to insure the accuracy of the information presented, and special effort has been made to assure that information reflects the state-of-the-art, neither the American Wood Council nor its members assume any responsibility for any part prepared from this on-line Connection Calculator. Those using this on-line Connection Calculator assume all liability from its use.

The Connection Calculator was designed and created by Cameron Knudson, Michael Dodson and David Pollock at Washington State University. Support for development of the Connection Calculator was provided by [American Wood Council](#).

Provides users with a web-based approach to calculating capacities for single bolts, nails, lag screws and wood screws per the 2005 NDS. Both lateral (single and double shear) and withdrawal capacities can be determined. Wood-to-wood, wood-to-concrete, and wood-to-steel connections are possible.



Connection Calculator available for the [iPhone](#).





# CARUSO TURLEY SCOTT

## structural engineers

1215 W. Rio Salado Parkway, Suite 200  
Tempe, Arizona 85281  
T: 480 774-1700 F: 480 774-1701  
www.ctsoz.com

Job Name: T-Mobile TI  
Job No.: 24-1374 Sheet No.: 37  
By: JKC Date: Nov-24

Connection Calculator

<https://www.awc.org/codes-standards/calculators-software/connectioncalc>

Design Method	Allowable Stress Design (ASD)
Connection Type	Lateral loading
Fastener Type	Wood Screw
Loading Scenario	Single Shear
<a href="#">Submit Initial Values</a>	

Main Member Type	Douglas Fir-Larch
Main Member Thickness	3.5 in.
Main Member: Angle of Load to Grain	0
Side Member Type	Steel
Side Member Thickness	20 gage
Side Member: Angle of Load to Grain	0
Wood Screw Number	12 (D = 0.216 in.)
Length	2.5 in.
Load Duration Factor	C <sub>D</sub> = 1.6
Wet Service Factor	C <sub>M</sub> = 1.0
End Grain Factor	C <sub>eg</sub> = 1.0
Temperature Factor	C <sub>t</sub> = 1.0

### Calculate Connection Capacity

<a href="#">Connection Yield Mode Descriptions</a>	<a href="#">Limits of Use</a>
<a href="#">Diaphragm Factor Help</a>	<a href="#">Load Duration Factor Help</a>
<a href="#">Show Printable View</a>	<a href="#">Technical Help</a>

## Connection Yield Modes


Im	1418 lbs.
Is	276 lbs.
II	577 lbs.
III <sub>m</sub>	602 lbs.
III <sub>s</sub>	228 lbs.
IV	322 lbs.

Adjusted ASD Capacity	228 lbs.
-----------------------	----------

- Wood Screw bending yield strength of 80000 psi is assumed.
- Dowel bearing strengths for wood screws with nominal diameter greater than 1/4 in. are calculated and rounded to the nearest accordance with NDS Table 11.3.2.
- Length of tapered tip is assumed to be two times the nominal wood screw diameter for calculating dowel bearing length in t
- ASTM A36 Steel is assumed for steel side members 1/4 in. thick, and ASTM A653 Grade 33 Steel is assumed for steel side members greater than 1/4 in. thick.

While every effort has been made to insure the accuracy of the information presented, and special effort has been made to assure th

## Structural Survey by Apex Tech Solutions

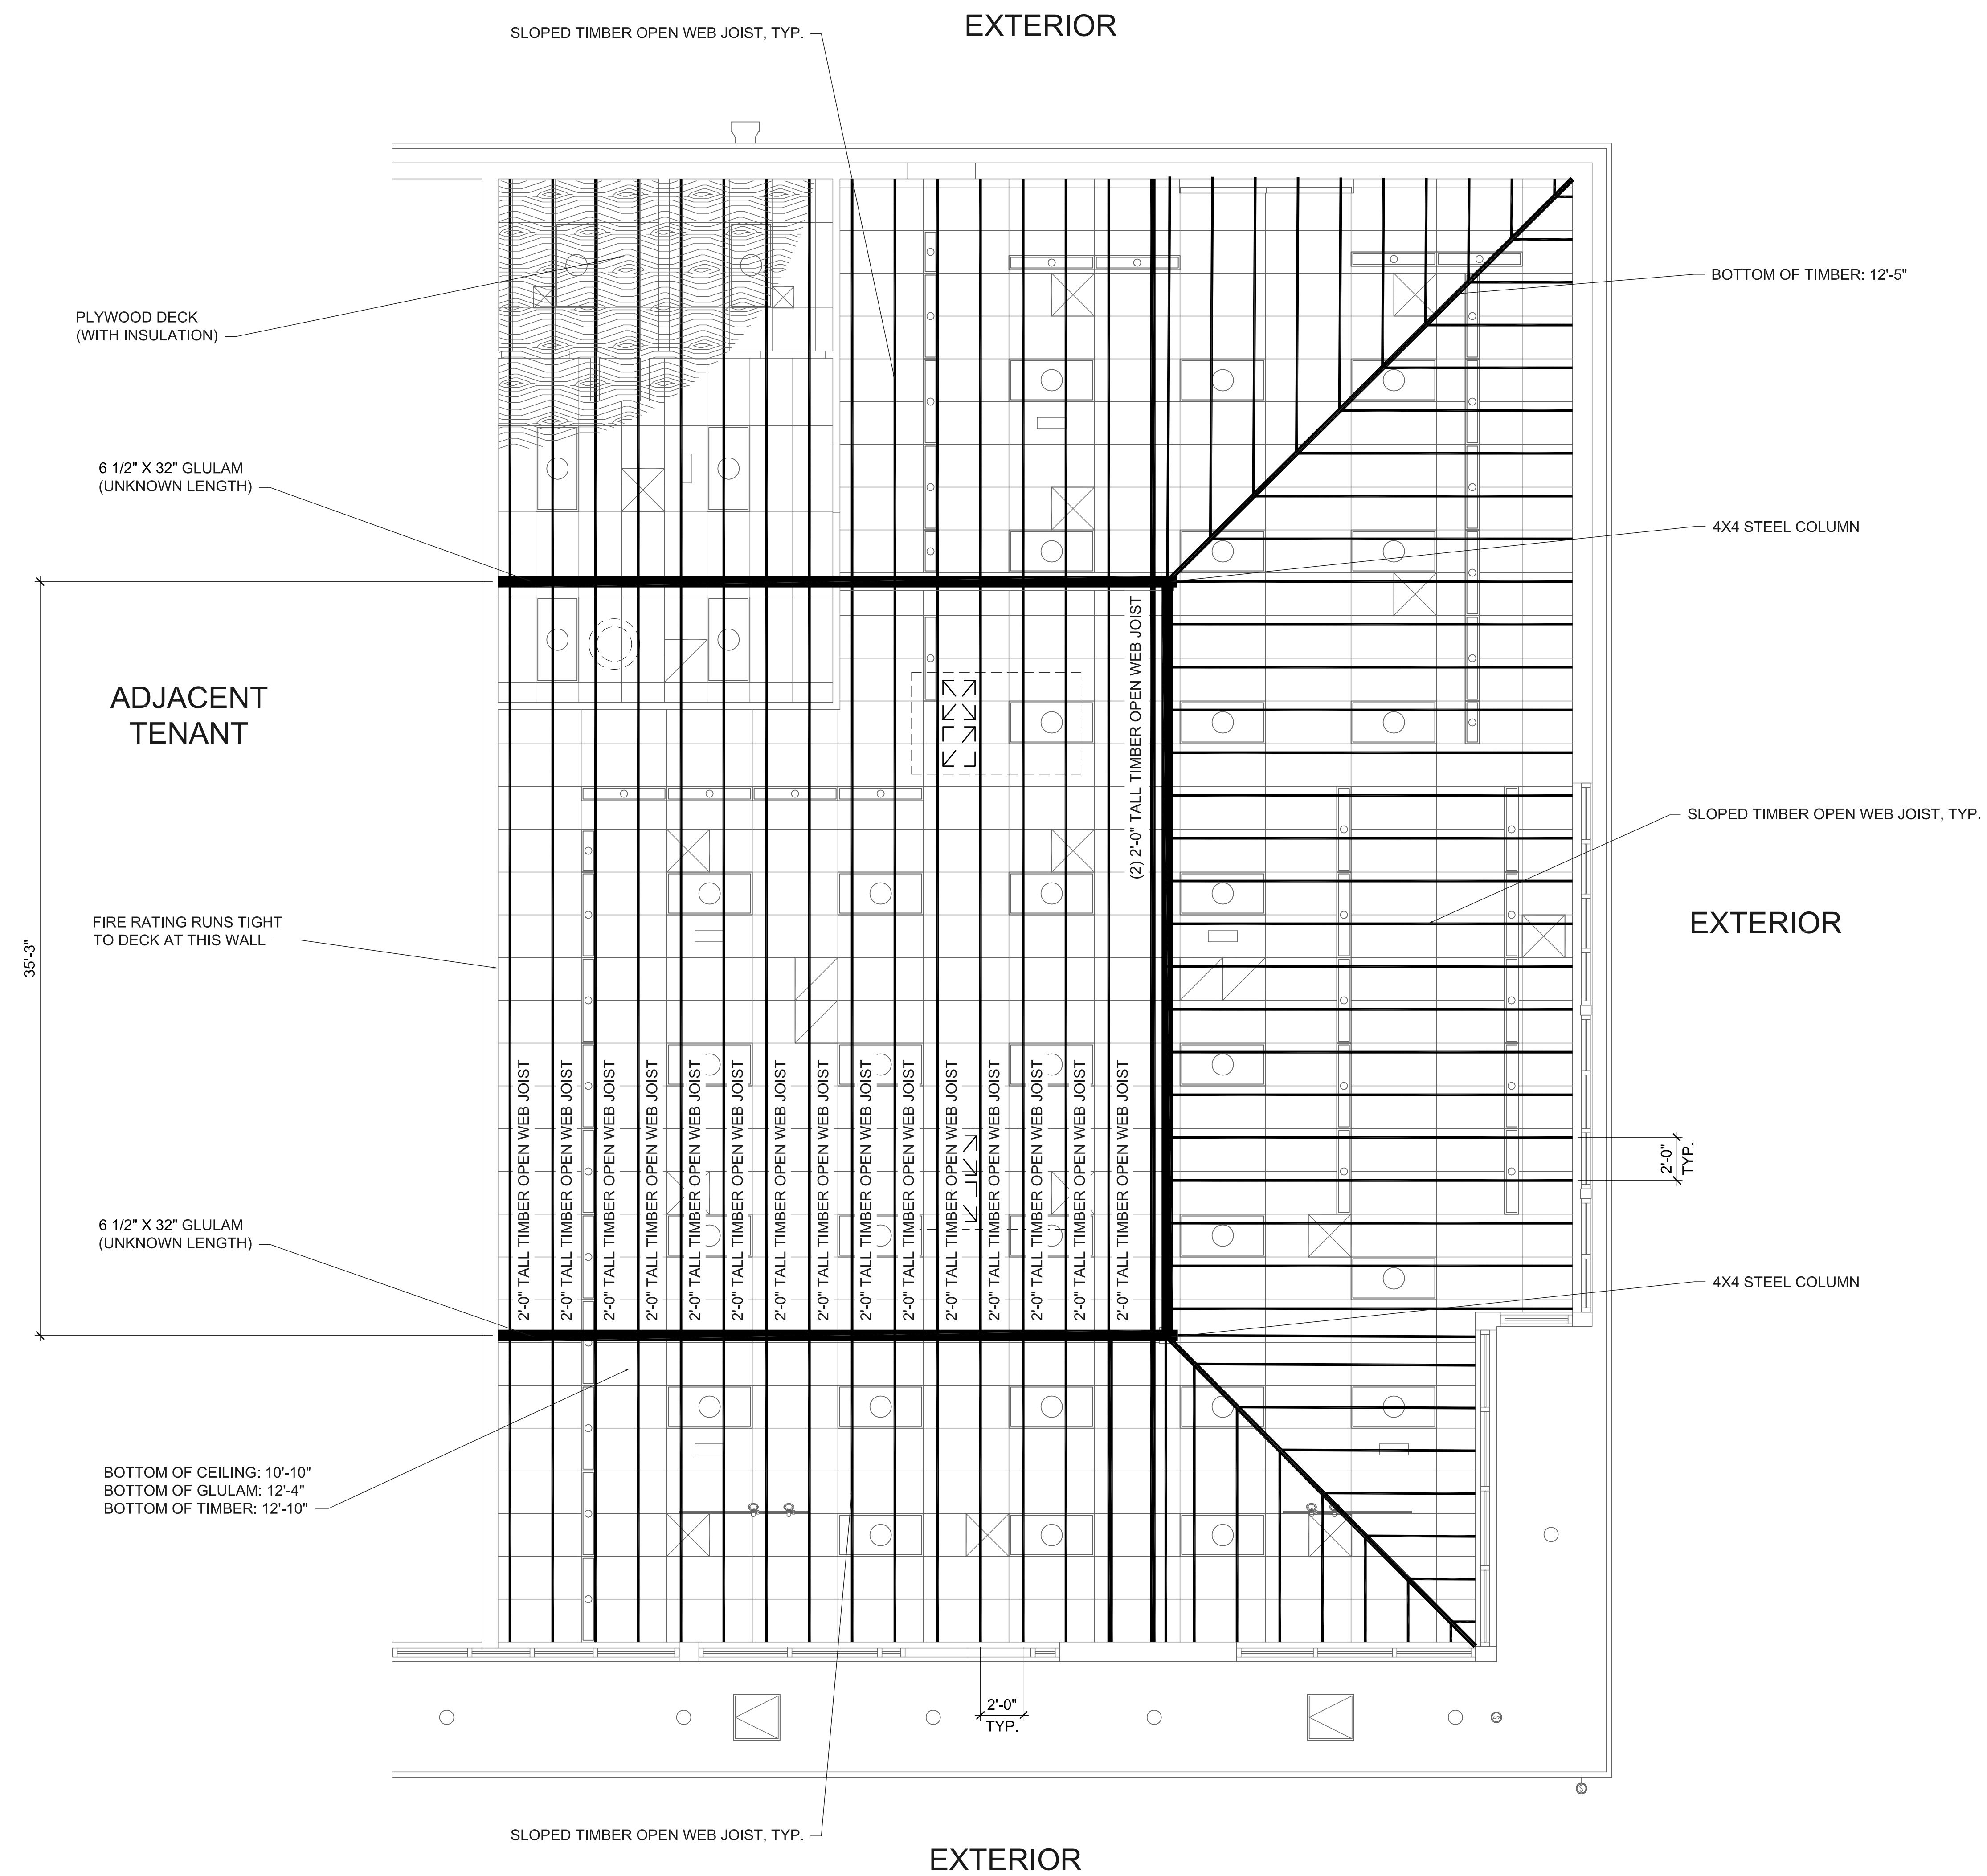

## STRUCTURAL PLAN



T-MOBILE  
STORE #  
4227 S. MERIDIAN, SUITE E  
PUYALLUP, WA. 98373

NOT FOR  
CONSTRUCTION

JOB NUMBER:  
DATE: 10/15/2024

SHEET NO: **AB-10**