



PRRWF20241913 UltraWall

Project: Centeris Voltage Park - North Pond
Location: Puyallup, WA
Designer: KDH
Date: 11/26/2024
Section: 5' Total H
Design Method: AASHTO_LRFD_2020
Design Unit: UltraBlock: 1

Seismic Acc: 0.250g

SOIL PARAMETERS	ϕ	coh	γ
Retained Soil:	33 deg	0 lbf/ft ²	125 lbf/ft ³
Foundation Soil:	32 deg	0 lbf/ft ²	120 lbf/ft ³
Leveling Pad:	40 deg	0 lbf/ft ²	140 lbf/ft ³
Crushed Stone Lvlng Pad			

GEOMETRY


Design Height:	4.92 ft	Live Load:	0.00 lbf/ft ²
Wall Batter/Tilt:	0.00/ 5.70 deg	Live Load Offset:	0.00 ft
Embedment:	1.00 ft*	Live Load Width:	0.00 ft
Leveling Pad Depth:	0.50 ft		
Slope Angle:	26.6 deg	Dead Load:	0.0 lbf/ft ²
Slope Length:	30.0 ft	Dead Load Offset:	0.0 ft
Slope Toe Offset:	1.0 ft	Dead Load Width:	0.00 ft
Leveling Pad Width:	5.92 ft	D.L. Embedment:	0.00 ft

Vert δ on Single Dpth

* Note: For all designs the passive resistance in front of the wall units is ignored for sliding calculations.



Water

Front Height:	3.92 ft
Internal Ht:	3.92 ft
Drainage Depth:	1.00 ft

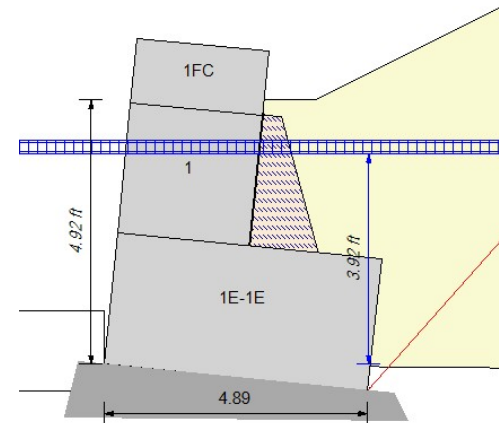

12/09/2024

Calculations required to be provided by
the Permittee on site for all Inspections

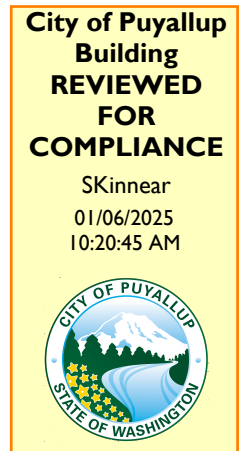




RESULTS (Static / Seismic)

CDR Sliding: 2.04 (Ivlpd) / 1.54 CDR Brng: 1.71 / 4.36
Eccentricity (e/L): 0.26 (e/L <= 0.33) / [0.27 (e/L <= 0.40)] Bearing: 1338 / 955 / 1053 (Service)
Ecc Internal(e/L): 0.10 (e/L <= 0.45)

Name	Elev.	ka	kae	Pae	Paw1	Paw2	Paw3	Pif	Pwd	(Pwr)	PaT	PaTs	CDRsl	seisCDRsl	e/L	Seis e/L (Pae/Pir)
1FC	4.84	0.360	0.000	0	0	0	0	106	0	0	0	106	30247.69	73.14 / 36.62	0.03	0.00
1	2.42	0.254	0.254	87	0	0	59	260	70	-70	59	459	43.00	22.54 / 16.33	0.10	0.00
1E-1E	0.00	0.701	0.701	917	44	343	403	494	479	-479	791	2244	2.04	2.28 / 1.54	0.24	0.00

Column Descriptions:

ka: active earth pressure coefficient; kae: active seismic earth pressure coefficient
Paw1: active earth pressure of soils above the water line
Paw2: active earth pressures (1) of submerged soils below the water line
Paw3: active earth pressures (2) of submerged soils below the water line
Pwd: driving pressures of water from behind the face
Pwr: resisting pressures of water in front of wall
Pif: Inertia of the facing units, Pir: Inertia of the gravel fill behind the units.
Paq: live surcharge earth pressure
Paqd: dead surcharge earth pressure
(PaC): reduction in load due to cohesion
PaT: sum of all earth pressures
CDRsl (IvlPad): 'Capacity/Demand Ratio' for sliding at each layer. (CDR sliding below the leveling pad)
e/L: eccentricity/base width ratio
e/L (Srvs): service state condition eccentricity/base width ratio
%D/H: ratio of based depth to height (warning for narrow walls, < 35%)

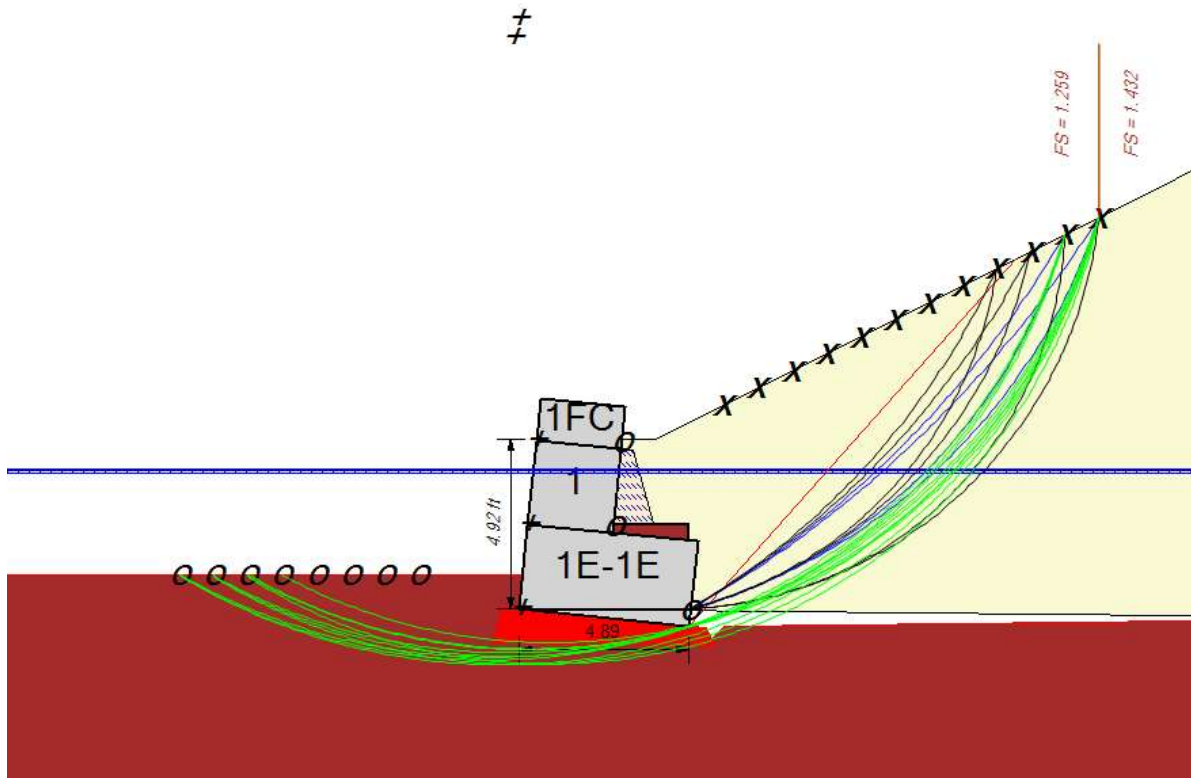



COMPOUND RESULTS

Compound stability is a global analysis (Bishop) with the failure planes originating at the top of the slope / wall and exiting out through the face of the wall. For MSE walls, the resistance of the geogrid reinforcement is included in the analysis and the shear resistance of the face units is included.

ID	Enter Point X	Enter Point Y	Exit Point X	Exit Point Y	Center X	Center Y	Radius	FoS
3	16.72	11.32	4.92	0.00	-0.06	16.99	17.71	1.43
2	16.72	11.32	4.92	0.00	-11.96	29.41	33.91	1.44
2	15.73	10.82	4.92	0.00	-10.02	25.75	29.77	1.49
3	15.73	10.82	4.92	0.00	0.68	15.05	15.63	1.49
4	16.72	11.32	4.92	0.00	4.15	12.61	12.64	1.54
2	14.75	10.33	4.92	0.00	-8.22	22.35	25.92	1.54
3	14.75	10.33	4.92	0.00	1.35	13.24	13.71	1.56
4	15.73	10.82	4.92	0.00	4.48	11.25	11.26	1.62
2	13.76	9.84	4.92	0.00	-6.56	19.22	22.38	1.62
3	13.76	9.84	4.92	0.00	1.95	11.57	11.94	1.64
2	12.78	9.35	4.92	0.00	-5.04	16.36	19.15	1.71
3	12.78	9.35	4.92	0.00	2.48	10.03	10.32	1.75
2	11.80	8.85	4.92	0.00	-3.66	13.76	16.21	1.84
2	10.81	8.36	4.92	0.00	-2.42	11.43	13.58	2.00
2	9.83	7.87	4.92	0.00	-1.32	9.36	11.25	2.22
2	8.84	7.37	4.92	0.00	-0.38	7.55	9.23	2.54
5	16.72	11.32	2.70	2.42	6.17	12.45	10.61	4.90
4	16.72	11.32	2.70	2.42	4.36	15.30	12.98	5.08
5	15.73	10.82	2.70	2.42	6.23	11.26	9.51	5.33
4	15.73	10.82	2.70	2.42	4.60	13.78	11.52	5.47

GLOBAL RESULTS

Global stability is a global analysis (Bishop) with the failure planes originating at the top of the slope / wall and exiting out below the wall in the area in front of the structure. For MSE walls, the resistance of the geogrid reinforcement is included in the resisting forces. The curve may go through the base of the wall and the wall shear would be included. In most cases the failure plane will pass below the structure.

ID	Enter Point X	Enter Point Y	Exit Point X	Exit Point Y	Center X	Center Y	Radius	Mo	Mr	FoS
1	16.72	11.32	-8.80	1.00	-0.20	16.43	17.67	85197.97	106747.02	1.26
1	16.72	11.32	-7.82	1.00	0.36	15.87	16.97	81569.52	102034.43	1.26
1	16.72	11.32	-9.79	1.00	-0.75	16.99	18.37	89416.52	112833.33	1.27
2	16.72	11.32	-9.79	1.00	-0.51	16.36	17.95	90283.07	115276.75	1.29
2	16.72	11.32	-7.82	1.00	0.90	14.59	16.15	82923.74	106466.66	1.29
1	15.73	10.82	-8.80	1.00	-0.32	15.35	16.67	74846.82	96000.57	1.29
1	15.73	10.82	-7.82	1.00	0.24	14.82	16.00	71149.02	91315.94	1.29
2	16.72	11.32	-8.80	1.00	0.20	15.46	17.03	86213.28	110832.84	1.29
1	15.73	10.82	-9.79	1.00	-0.86	15.88	17.35	78742.61	101607.44	1.30
1	16.72	11.32	-6.84	1.00	0.94	15.30	16.27	77424.94	99857.91	1.30



DESIGN DATA

Load Factors for Design

AASHTO Table 3.4.1-1 & 3.4.1-2

Load Case	Str_Max	Str_Min	Extreme Max	Extreme Min	Service
Str I Dead Load (DC)	1.25	0.90	1.00	1.00	1.00
Soil Load Driving (EH)	1.50	0.90	1.00	1.00	1.00
Str I Vert Earth Load (EV)	1.35	1.00	1.00	1.00	1.00
Dead Load Surcharge (ES)	1.50	0.75	1.00	1.00	1.00
Live Load (LL, PL, LS)	1.75	0.00	1.00	0.00	1.00

Application of Load Factors

Group	DC	EV	LS	EH	Probable Use
Strength I-a	0.90	1.00	1.75	1.50	BC/EC/SL
Strength I-b	1.25	1.35	1.75	1.50	BC (max. value)
Service I	1.00	1.00	1.00	1.00	Settlement

Notes: BC - Bearing Capacity; EC - Eccentricity; SL - Sliding

By Inspection:

- Strength I-a (minimum vertical loads and maximum horizontal loads) will govern for the case of sliding and eccentricity (overturning); and
- For the case of bearing capacity, maximum vertical loads will govern, and the factored loads must be compared for Strength I-b.



DESIGN DATA

Load Factors for Design

MINIMUM DESIGN REQUIREMENTS

Minimum embedment depth

Min_emb = 1.00 ft

INPUT DATA

Geometry

Wall Geometry

Design Height, top of leveling pad to finished grade at top of wall

H = 4.92 ft

Embedment, measured from top of leveling pad to finished grade

emb = 1.00 ft

Leveling Pad Depth

Thickness = 0.50 ft

Face Batter, measured from vertical

i = 0.00 deg

Slope Geometry

Back Slope Angle, measured from horizontal

β = 26.60 deg

Back Slope Toe Offset, measured from back of the face unit

STL_offset = 1.00 ft

Back Slope Length, measured from toe to crest

SL_Length = 30.00 ft

NOTE: If the back slope toe is offset or the slope breaks within three times the wall height, a Coulomb Trial Wedge method of analysis is used.

Toe Slope Angle, measured from horizontal

β = 0.00 deg

Toe Slope Crest Offset, measured from front of the face unit

STL_offset = 0.00 ft

Toe Slope Length, measured from crest to toe

SL_Length = 0.00 ft

Surcharge Loading

Live Load, assumed transient loading (e.g. traffic)

LL = 0.00 lbf/ft²

Live Load Offset, measured from back face of wall

LL_offset = 0.00 ft

Live Load Width, assumed strip loading

LL_width = 0.00 ft



Soil Parameters

Retained Zone

Angle of Internal Friction	$\Phi = 33.00 \text{ deg}$
Cohesion	$\text{coh} = 0.00 \text{ lbf/ft}^2$
Moist Unit Weight	$\gamma = 125.00 \text{ lbf/ft}^3$

Foundation

Angle of Internal Friction	$\Phi = 32.00 \text{ deg}$
Cohesion	$\text{coh} = 0.00 \text{ lbf/ft}^2$
Moist Unit Weight	$\gamma = 120.00 \text{ lbf/ft}^3$

Leveling Pad

Angle of Internal Friction	$\Phi = 40.00 \text{ deg}$
Cohesion	$\text{coh} = 0.00 \text{ lbf/ft}^2$
Moist Unit Weight	$\gamma = 140.00 \text{ lbf/ft}^3$



RETAINING WALL UNITS

STRUCTURAL PROPERTIES:

N is the normal force [or factored normal load] on unit to unit interface

The unit to unit shear is $N \times \tan(0.0) + 3619.6$

N is the normal force [or factored normal load] on the base unit

The default leveling pad to base unit shear is $0.8 * \tan(40)$, or 34 deg. [AASHTO LRFD 10.6.3.4-2] or may be the manufacturer supplied data.

[Note: concrete to concrete has a coefficient of $\Phi 0.6$ N.

Table of Values:



CALCULATION RESULTS

OVERVIEW

UltraWall calculates stability assuming the wall is a rigid body. Forces and moments are calculated about the base and the front toe of the wall. The base block width is used in the calculations. The concrete units and granular fill over the blocks are used as resisting forces.

EARTH PRESSURES

The method of analysis uses the Coulomb Earth Pressure equation (below) to calculate active earth pressures. Wall friction is assumed to act at the back of the wall face. The component of earth pressure is assumed to act perpendicular to the boundary surface. The effective δ angle is δ minus the wall batter at the back face. If the slope or live load break within the failure zone, a trial wedge method of analysis is used.

EXTERNAL EARTH PRESSURES

Effective δ angle (3/4 retained ϕ)
Coefficient of active earth pressure

$\delta = 24.8 \text{ deg}$
 $k_a = 0.701$


External failure plane
Back Face Angle from horizontal
Coefficient of passive earth pressure

$\rho = 47 \text{ deg}$
 $\theta = 69.14 \text{ deg}$
 $k_p = 0.00$

$$k_a = \frac{\sin^2(\theta + \phi'_f)}{\Gamma [\sin^2 \theta \sin(\theta - \delta)]}$$

in which:

$$\Gamma = \left[1 + \sqrt{\frac{\sin(\phi'_f + \delta) \sin(\phi'_f - \beta)}{\sin(\theta - \delta) \sin(\theta + \beta)}} \right]$$

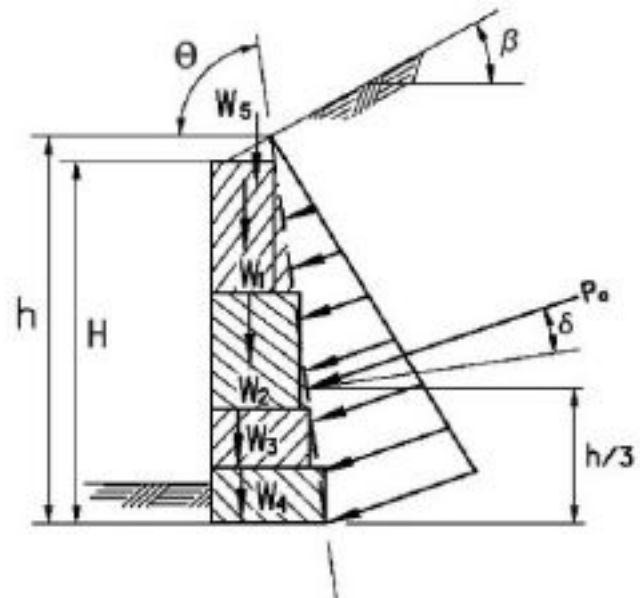



FORCE DETAILS

The details below shown how the forces are calculated for each force component. The values shown are not factored. All loads are based on a unit width (ppf / kNpm).

Layer	Block Wt	Soil Infill Wt	Soil Wedge Wt
1	423.04	0.00	0.47
2 w	616.29	0.00	174.56
3 w	937.94	0.00	

Block Weight = 1977.26 lbf/ft

X-Arm = 3.86 ft

Soil Infill Weight = 0.00 lbf/ft

X-Arm = 0.00 ft

Soils Wedge Weight = 175.04 lbf/ft

X-Arm = 3.47 ft

Active Earth Pressure $P_a = 916.70$ lbf/ft

P_{a_h} (Force H) = $P_a \cos(\delta - \omega) = 916.70 \times \cos(24.75 - (-20.86)) = 553$ lbf/ft

Y-Arm = 1.64 ft

P_{a_v} (Force V) = $P_a \sin(\delta - \omega) = 916.70 \times \sin(24.75 - (-20.86)) = 565$ lbf/ft

X-Arm = 4.27 ft



FORCES AND MOMENTS

The program resolves all the geometry into simple geometric shapes to make checking easier. All x and y coordinates are referenced to a zero point at the middle of the base block for eccentricity calculations.

LOADS FOR ECCENTRICITY ABOUT THE CENTER OF THE BASE

Name	Factor γ	Force (V)	Force (H)	X-len	Y-len	Mo	Mr
Face Blocks(W1)	1.00	1977.26		-1.415			-3280.12
Soil Wedge(W2)	1.00	175.04		-1.026			-179.88
Pa_h	1.00		552.95		1.754	969.77	
Pa_v	1.00	564.92		-1.796			-1113.12
Sum V / H	1.00	2717	553		Sum Mom	970	-4573

W0: stone within units

W1: facing units

W2: soil wedge behind the face

X-Len: is measured from the center of the base (+) Driving, (-) Resisting.

Pa_h: horizontal earth pressure

Pa_v: vertical earth pressure

Pq_h: horizontal surcharge pressure

Pq_v: vertical surcharge pressure



FORCES AND MOMENTS FACTORED FOR Str I-a

UltraWall increases all driving forces and reduces the resisting forces by the factors shown for Str I.

FACTORED LOADS: Str Ia

Name	FactorMax γ	FactorMin γ	ForceSldg (V)	ForceEcc (V)	Force (H)	X-len	Y-len	Mo	Mr
Face Blocks(W1)	1.25	0.90	1779.53	1779.53		-1.415			-2952.11
Soil Wedge(W2)	1.35	1.00	175.04	175.04		-1.026			-179.88
Paw_h	1.50				829.43		1.754	1454.66	
Paw_v		0.90	847.38	847.38		-1.796			-1001.81
Sum V / H			2802	2802	829		Sum Mom	1455	-4802

FORCES AND MOMENTS FACTORED FOR Str I-b

UltraWall increase resisting forces and increases driving forces by the factors shown for Str I-b.

FACTORED LOADS: Str Ib

Name	Factor γ	Force (V)	Force (H)	X-len	Y-len	Mo	Mr
Face Blocks(W1)	1.25	2471.58		-1.415			-4100.15
Soil Wedge(W2)	1.35	236.30		-1.026			-242.83
Pa_h	1.50		829.43		1.754	1454.66	
Pa_v	1.50	847.38		-1.796			-1669.68
Sum V / H		3555	829		Sum Mom	1455	-6013



BASE SLIDING

Sliding at the base is checked at the block to leveling pad interface between the base block and the leveling pad.

Forces Resisting sliding

$$N = W1(DCr) + W2(EVr) + Pav(EHd)$$

$$(1,977 \times 0.90) + (175 \times 1.00) + (565 \times 1.50)$$

$$N = 2,802 \text{ lbf/ft}$$

Sliding between Concrete Units and Leveling Pad/Drain Mat (Rf1)

Resisting force at pad = (θ N tan(slope)) x RFsl

$$RF1 = (0.8 \times 2,802 \times \tan(40.00) + 0.0) \times 0.90$$

$$Rf1 = 1,693$$

Driving force is the horizontal component of

Pah(EHd)

$$DF = (553 \times 1.50)$$

$$Df = 829$$

$$CDR = (Rf1 / Df)$$

$$CDR = 2.04$$



ROW TO ROW SLIDING

Sliding between rows is checked at the interface between two adjacent rows.

Details of the calculation are shown on the previous page. The leveling pad interaction is now replaced with the unit/unit interaction.

RESULTS TABLE FACTORED

Elev[ft]	N[lbf/ft]	Shear Intcpt	Resisting Force	Driving Force[lbf/ft]	CDR Sliding/Shear
4.84	380.73	3,257.59	3,463.19	0.11	30,247.69
2.42	935.39	3,257.59	3,762.71	87.51	43.00



ECCENTRICITY

Eccentricity at the base is checked by assuming rotation by the block mass and the soil retained on the blocks. Allowable overturning can be defined by eccentricity (e/L).

Moments Resisting =

$$M1(DCr) + M2(EVr) + MPav(EHd)$$

$$((-3,280 \times 0.90) + (-180 \times 1.00) + (-1,113 \times 1.50))$$

$$Mr = 4,802 \text{ ft-lbs}$$

Moments Driving = $MPah(EHd) + M0(EVd)$

$$(970 \times 1.50) + (0 \times 1.35) + (0 \times 1.50)$$

$$Mo = 1,455 \text{ ft-lbs}$$

$$e = (Mr - Mo) / N$$

$$e = (4,802 - 1,455) / 2,802$$

$$e/L = 1.19 / 4.92$$

$$e = 1.19$$

$$e/L = 0.24$$



ROW TO ROW ECCENTRICITY

Eccentricity is checked by assuming rotation by the block mass and the soil retained on the blocks about the row below. Factored eccentricity can be defined by eccentricity/Length (e/L).

RESULTS TABLE FACTORED

Elev[ft]	Mr[ft lbf/ft]	Mo[ft lbf/ft]	Sum Vertical[lbf]	Ecc[ft]	BlockLength	Ecc/L
4.84	24.68	0.01	380.73	0.06	2.46	0.03
2.42	264.19	43.70	935.39	0.24	2.46	0.10



ECCENTRICITY AND BEARING

Eccentricity is the calculation of the distance of the resultant force away from the centroid of the mass. This measure is an indication of the overturning of the mass. UltraWall uses an allowable eccentricity of $9/20 L$ for concrete to concrete bearing surfaces and a concrete leveling pad (thickness > 1.0 ft), or $L/3$ for bearing on soil per the AASHTO LRFD guidelines. Eccentricity is still used as a guide to design in some design methods.

UltraWall calculates three eccentricities:

1) Maximum eccentricity (overturning) where it uses the maximum driving forces combined with the minimum resisting forces (see overturning) [Str I-a]. 2) Maximum bearing where it uses the maximum driving forces combined with the maximum resisting forces [Str I-b]. 3) Service: Maximum bearing where it uses the actual driving forces combined with the actual resisting forces in Service loading.

Calculation of Eccentricity for maximum bearing

Moments resisting = $M1(DC_d) + M2(EV_d) + MP_a(EH_d)$

$(-3,280 \times 1.25) + (-180 \times 1.35) + (-1,113 \times 1.50)$

$Mr = 6,013 \text{ ft-lbs}$

Moments driving = $+ MP_{ah}(EH_d)$

$+ (970 \times 1.50)$

$Mo = 1,455 \text{ ft-lbs}$

$Nb = W1(DC_d) + W2(EV_d) + WP_a(EH_d)$

$(1,977 \times 1.25) + (175 \times 1.35) + (565 \times 1.50)$

$Nb = 3,555 \text{ lbf/ft}$

N bearing = $W1(DC_d) + W2(EV_d) + WP_{Ivlpad}(EV_d) + WP_a(EH_d)$

$(1,977 \times 1.25) + (175 \times 1.35) + (193 \times 1.35) + (565 \times 1.50)$

$Nbrg = 3,816 \text{ lbf/ft}$

Calculate Eccentricity (absolute values used for parameters)

$e = (Mr - Mo) / Nb$

$e = (6,013 - 1,455) / 3,555$

$e = 1.282$



BEARING

Bearing Capacity Factors [Foundation]

$N_c = 35.490$ Myerhoff Eqn
 $N_q = 23.177$ Myerhoff Eqn
 $N_g = 30.215$ Vesic Eqn

Shape Factors [Foundation]

$S_c = 1.065$
 $S_q = 1.062$
 $S_g = 0.960$

Depth Correction Factor

$d_f = 1.082$

Modified Bearing Capacity Factors [Foundation]

$N_{cm} = N_c \times S_c = 37.808$
 $N_{qm} = N_q \times S_q = 26.639$
 $N_{gm} = N_g \times S_g = 29.006$

Water Correction Factor

$C_{wq} = 0.500$
 $C_{wg} = 0.500$

$B'f = B - 2e + \text{vlIPad Thickness (Bearing area at foundation)}$
 $B'f = 4.92 - 2 \times 1.28 + 0.50$

$B'f = 2.85 \text{ ft}$

$q = \text{embedment} \times \gamma$
 $= 1.00 \times 120.00$

$q = 180.00 \text{ lbf/ft}^2$

Calculation of Bearing Pressures Foundation

$$q_r = (c \times N_{cm} + q \times N_{qm} \times C_{wq} + 0.5 \times \gamma \times B' \times N_{gm} \times C_{wg}) \times R_{Fbr}$$

$$[(0.000 \times 37.808) + (120 \times 26.639 \times 0.500) + (0.5 \times 120 \times 2.853 \times 29.006 \times 0.500)] \times 0.45$$

Calculate Factored Bearing, q_r
Bearing Pressures (σ)
Calculated CDR for bearing

$q_r = 2,287.23 \text{ lbf/ft}^2$
 $N_{brg}/B'f = 1,337.88 \text{ lbf/ft}^2$
 $q_r/\sigma = 1.71$

Design	Sum Vert	Mo	Mr	e	Qal	Sigma	CDR
Strength I-b	3816	1455	-6013	1.282	2287	1338	1.71
Service	2911	970	-4573	1.326	2250	1053	2.14



SEISMIC CALCULATIONS

The loads considered under seismic loading are primarily inertial loadings. The wave passes the structure putting the mass into motion and then the mass will try to continue in the direction of the initial wave. In the calculations you see the one dynamic earth pressure from the wedge of the soil behind the reinforced mass, and then all the other forces come from inertia calculations of the face put into motion and then trying to be held in place.

Design Ground Acceleration As = Fpae * PGA = 0.250

Assumed deformation = Def = 0.00 in
(with deformation, the kh is reduced by 50%)

Horizontal Acceleration kh = 0.250
Vertical Acceleration kv = 0.000

INERTIA FORCES OF THE STRUCTURE

Pif = (W1 * kh)
(1977.26 * 0.250) Pif = 494.32

SEISMIC THRUST

Coefficient of active seismic earth pressure Kae Kae = 0.701
D_Kae = Kae - Ka = (0.701 -0.701) D_Kae = 0.000
Pae = 0.5*gamma*(H)^2 * DKae Pae = 0.00 lbf/ft
Pae_h = Pae*cos(delta) Pae_h = 0.00 lbf/ft
Pae_v = Pae*sin(delta) Pae_v = 0.00 lbf/ft

In AASHTO LRFD, two cases are looked at: 1) 100% Pae and 50% of Pir, and 2) 50% Pae and 100% Pir.

TABLE OF RESULTS FOR SEISMIC REACTIONS



SEISMIC SLIDING

Details are only shown for sliding at the base of blocks, a check is made at the foundation level with the answer only shown.

The vertical resisting forces are

$$\text{Units}(1.0) + \text{SoilWedge}(1.0) + \text{Pa}_v(1.0)$$

$$(1977 * 1.0) + (175 * 1.0) + (565 * 1.0)$$

Note Pae_v changes between case 1 and case 2, to $\text{Pae}_v/2$

Case 1, 100% Pae & 50% Pir

$$\text{SumVs}_{\text{Pae}} = 2717$$

Case 2, 50% Pae & 100% Pir

$$\text{SumVs}_{\text{Pir}} = 2435$$

$$\text{Resisting force 1} = (\text{SumVs}_{\text{Pae}} * \tan(\text{slope}) + \text{intercept} * L) * \text{RFsl}$$

$$\text{FReS1} = 1698 \text{ lbf/ft}$$

$$\text{Resisting force 2} = (\text{SumVs}_{\text{Pir}} * \tan(\text{slope}) + \text{intercept} * L) * \text{RFsl}$$

$$\text{FReS2} = 1634 \text{ lbf/ft}$$

$$\text{The inertial force Pif} = \text{Face} * kh(1.0) + \text{Soil Wedge} * kh * (1.0)$$

$$\text{Driving force} = + \text{Pa}_h(1.0) + \text{Pif}_h/2(1.0)$$

[case 2 is 50% Pae , 100% Pir]

$$(553 * 1.0) + (494/2 * 1.0)$$

$$\text{FDrS1} = 800 \text{ lbf/ft}$$

$$\text{FDrS2} = 1059 \text{ lbf/ft}$$

$$\text{CDR} = (\text{FReS1}/\text{FDrS1}) / (\text{FReS2}/\text{FDrS2})$$

$$\text{CDR} = 2.28 / 1.54$$



SEISMIC ECCENTRICITY

Eccentricity is rotation about the center of the wall and is a check on overturning.

Resisting Moment =
(case 2 is 50% Pae)

MomReS [Pae] = -4573 ft lbf/ft
MomReS [Pir] = -3460 ft lbf/ft

Driving Moment =
 $P_{a_h}(1.0) + P_{if_h}/2(1.0)$
 $(970 * 1.0) + (1604/2 * 1.0)$

MomDrS [Pae] = 970 ft lbf/ft
MomDrS [Pir] = 0 ft lbf/ft

$e = (M_r - M_o) / N$
 $e [Pae] = (4573 - 970) / 2717$
 $e/L = 0.27$
 $e [Pir] = (3460 - 0) / 2435$
 $e/L = 0.29$

$e = 1.33$

$e = 1.42$



SEISMIC BEARING

Bearing is the ability of the foundation to support the mass of the structure.

$$Q_{ult} = c \cdot N_c + q \cdot N_q + 0.5 \cdot \gamma \cdot (B') \cdot N_\gamma$$

where:

$$N_c = 35.49 \text{ Myerhoff Eqn}$$

$$N_q = 23.18 \text{ Myerhoff Eqn}$$

$$N_\gamma = 30.21 \text{ Vesic Eqn}$$

$$c = 0 \text{ lbf/ft}^2$$

$$q = (\text{emb} + \text{lvl pad}) \cdot \gamma(\text{EVsr}) = 180.00 \text{ lbf/ft}^2$$

Pae Values (100% Pae, 50% Pir)

Calculate Factored Bearing, Qult (seismic)

Equivalent Footing Width, $B' = L - 2e + \text{Lvl pad}$

Bearing Pressure = $\sum V_s / B' + B + \text{LP depth} / 2 \cdot \text{LP depth} \cdot \gamma$

CDR for Bearing = $(Q_{ults} \cdot R_{Fbr}) / \text{Bearing}$

$$Q_{ult} = 4,323 \text{ lbf/ft}^2$$

$$B' = 2.76 \text{ ft}$$

$$q = 991.64 \text{ lbf/ft}^2$$

$$\text{CDR} = 4.36$$

Pir Values (50% Pae, 100% Pir)

Calculate Factored Bearing, Qult (seismic)

Equivalent Footing Width, $B' = L - 2e + \text{Lvl pad}$

Bearing Pressure = $\sum V_s / B' + B + \text{LP depth} / 2 \cdot \text{LP depth} \cdot \gamma$

CDR for Bearing = $(Q_{ults} \cdot R_{Fbr}) / \text{Bearing}$

$$Q_{ult} = 6,400 \text{ lbf/ft}^2$$

$$B' = 2.87 \text{ ft}$$

$$q = 954.87 \text{ lbf/ft}^2$$

$$\text{CDR} = 4.53$$