



TECHNICAL DATA

VK3021 QUICK RESPONSE PENDENT SPRINKLER (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058

Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

1. DESCRIPTION

The Viking VK3021 Quick Response Pendent Sprinkler is a small thermosensitive glass bulb spray sprinkler available with various finishes and temperature ratings to meet design requirements. The special Polyester and Electroless Nickel PTFE (ENT) coatings can be used in decorative applications where colors are desired. In addition, these coatings have been investigated for installation in corrosive environments and are Listed and Approved as indicated in the Approval Chart.

2. LISTINGS AND APPROVALS



UL Listed: Category VNIV



FM Approved: Classes 2017, 2015, 2043

Refer to the Approval Chart and Design Criteria for requirements that must be followed.

3. TECHNICAL DATA

Specifications:

Minimum Operating Pressure: 7 psi (0.5 bar)

Rated to: 175 psi (12 bar) water working pressure.

Factory tested hydrostatically to 500 psi (34.5 bar).

Thread size: 1/2" NPT (15 mm BSP)

Nominal K-factor: 5.6 U.S. (80.6 metric*)

Glass-bulb fluid temperature rated to -65 °F (-55 °C)

* Metric K-factor measurement shown is in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.

Material Standards:

Sprinkler Body: Brass CW602N, UNS-C84400 or QM Brass

Deflector: Stainless Steel UNS S30400

Pip Cap Shell - Stainless Steel UNS-S44400

Pip Cap Disc - Stainless Steel UNS-S30100

Belleville Spring - Nickel Alloy

Pip Cap Seal - Polytetrafluoroethylene (PTFE)

Compression Screw: Brass CW612N, CW508L, UNS-C36000 or UNS-C26000

Shipping Cap: Polyethylene

Bulb: Glass, nominal 3 mm diameter

Finishes and Temperatures:

Finish	Brass	Chrome	White Polyester	Black Polyester	ENT	--
Suffix	A	F	M-/W	M-/B	JN	--
Temperature	135 °F (57 °C)	155 °F (68 °C)	175 °F (79 °C)	200 °F (93 °C)	286 °F (141 °C)	Open
Suffix	A	B	D	E	G	Z

Ordering Information: (Refer to Table 1 and the current Viking List Price Book.)

4. INSTALLATION

Refer to appropriate NFPA, FM Global, and/or any other applicable installation standards.

5. OPERATION

During fire conditions, when the temperature around the sprinkler reaches its operating temperature, the heat-sensitive liquid in the glass bulb expands, causing the bulb to shatter, releasing the pip cap assembly. Water flowing through the sprinkler orifice strikes the sprinkler deflector, forming a uniform spray pattern to extinguish or control the fire.

6. INSPECTIONS, TESTS AND MAINTENANCE



Refer to NFPA 25 for Inspection, Testing and Maintenance requirements.

7. AVAILABILITY

Viking Sprinkler Model VK3021 is available through a network of domestic and international distributors. See The Viking Corporation web site for the closest distributor or contact The Viking Corporation.

8. GUARANTEE

For details of warranty, refer to Viking's current list price schedule or contact Viking directly.

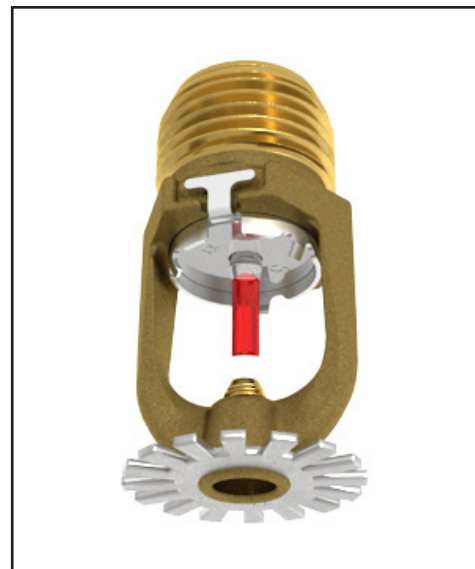



TECHNICAL DATA

VK3021 QUICK RESPONSE PENDENT SPRINKLER (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com
 Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

TABLE 1: ORDERING INFORMATION
 Instructions: Using the sprinkler base part number,
 (1) add the suffix for the desired Finish
 (2) add the suffix for the desired Temperature Rating.

Sprinkler Base Part No.	Size		1: Finishes		2: Temperature Ratings			
	NPT Inch	BSP mm	Description	Suffix ¹	Nominal Rating	Bulb Color	Max. Ambient Ceiling Temperature ³	Suffix
19917	1/2	--	Brass	A	135 °F (57 °C)	Orange	100 °F (38 °C)	A
19929	--	15	Chrome	F	155 °F (68 °C)	Red	100 °F (38 °C)	B
			White Polyester ^{4,6}	M-/W	175 °F (79 °C)	Yellow	150 °F (65 °C)	D
			Black Polyester ^{4,6}	M-/B	200 °F (93 °C)	Green	150 °F (65 °C)	E
			ENT ^{4,5,6}	JN	286 °F (141 °C)	Blue	225 °F (107 °C)	G
					Open	--	--	Z

Example: 19917MB/W = VK3021 with White Polyester Finish and 155 °F (68 °C) Nominal temperature rating. This sprinkler is to be installed into an area with a maximum ambient temperature of 100 °F (38 °C) meaning if the area will experience temperatures above the maximum ambient rating, you shall use a higher temperature-rated sprinkler.

Accessories

Sprinkler Wrenches (see Figure 1):

- A. Installer Wrench: Part No. 22055 (available since 2017).
- B. Cabinet Wrench: Part No. 20901M/B (available since 2017).
- C. Recessed Socket Wrench: Part No. 20951M/B² (available since 2017).

Sprinkler Cabinet:

- A. Up to 6 sprinklers: Part number 01724A (available since 1971).
- B. 6-12 Sprinklers: Part number 01725A (available since 1971).

Footnotes

1. Where a dash (-) is shown in the Finish suffix designation, insert the desired Temperature Rating suffix. See example above.
2. Requires a 1/2" ratchet which is not available from Viking.
3. Based on NFPA 13, NFPA 13R, and NFPA 13D. Other limits may apply, depending on fire loading, sprinkler location, and other requirements of the Authority Having Jurisdiction. Refer to specific installation standards.
4. UL Listed as corrosion resistant.
5. FM Approved as a corrosion proofing coating for installation in corrosive environments.
6. The corrosion resistant and corrosion proofing coatings have passed the standard corrosion test required by the approving agencies indicated in the Approval Chart. These tests cannot and do not represent all possible corrosive environments. Prior to installation, verify through the end-user that the coatings are compatible with or suitable for the proposed environment. For automatic sprinklers, the ENT coating is applied to all exposed exterior surfaces, including the waterway.

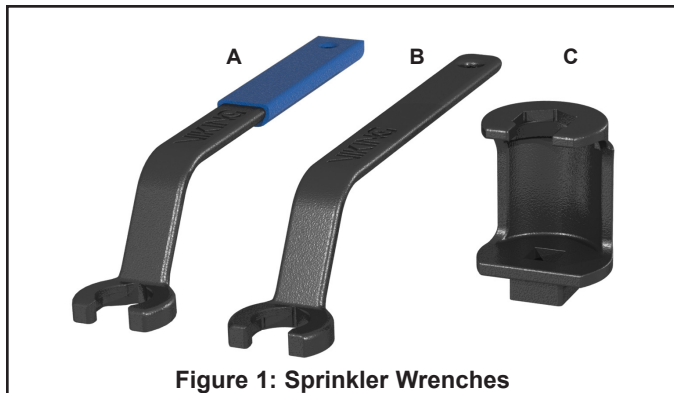


Figure 1: Sprinkler Wrenches

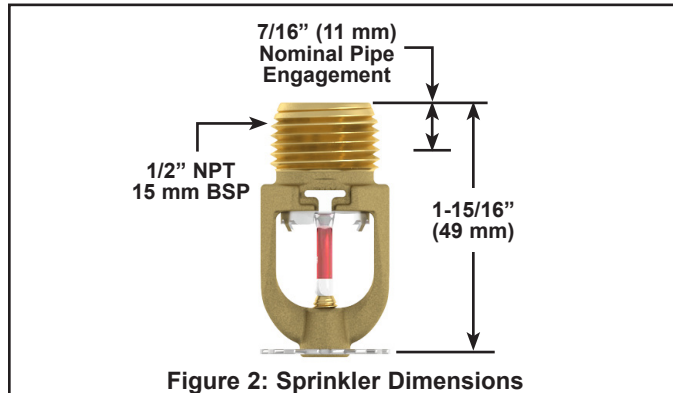


Figure 2: Sprinkler Dimensions



TECHNICAL DATA

VK3021 QUICK RESPONSE PENDENT SPRINKLER (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com
 Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

APPROVAL CHART Viking Quick Response Pendent Sprinkler VK3021 K5.6 (80.6 metric) Maximum 175 PSI (12 Bar) WWP				Finish(es) → Temperature(s) → A 1 X Escutcheon(s), If applicable →	KEY
Sprinkler Base Part Number ¹	Thread Size		Listings and Approvals ²		
	NPT Inch	BSP mm	UL	FM	
19917	1/2	--	A1, B2X, B3Y	A1, B2X, B3Y	
19929	--	15	A1, B2X, B3Y	A1, B2X, B3Y	
Approved Temperature Rating Code: A = 135 °F (57 °C), 155 °F (68 °C), 175 °F (79 °C), 200 °F (93 °C), and 286 °F (141 °C) B = 135 °F (57 °C), 155 °F (68 °C), 175 °F (79 °C), and 200 °F (93 °C)					
Approved Finish Code: 1 = Brass, Chrome, White Polyester ^{3,4} , Black Polyester ^{3,4} , and ENT ^{4,5} 2 = Brass, Chrome, White Polyester ^{3,4} , and Black Polyester ^{3,4} 3 = ENT ^{4,5}					
Approved Escutcheon Code: X = Installed with Viking Recessed Escutcheons Models NP-1, NP-2, and NP-3, Viking Adjustable Escutcheon Model NP-4, or Viking Standard Surface Mounted Escutcheons Y = Installed with Viking Model NP-1 Recessed Escutcheon OR Standard Surface Mounted Escutcheons					
Footnotes					
¹ Base Part number is shown. For complete part number, refer to Viking's current price schedule.					
² This table shows the listings and approvals available at the time of printing. Check with the manufacturer for any additional approvals.					
³ Other colors are available upon request with the same Listings and Approvals as the standard colors.					
⁴ cULus Listed as corrosion resistant.					
⁵ FM Approved as corrosion proofing for corrosive environments.					

DESIGN CRITERIA - UL

cULus Listing Requirements:

The Viking VK3021 Quick Response Pendent Sprinkler is cULus Listed as indicated in Approval Chart for installation in accordance with the latest edition of NFPA 13 for standard spray sprinklers.

- Designed for use in Light and Ordinary occupancies.
- The sprinkler installation rules contained in NFPA 13 for standard spray Pendent sprinklers shall be followed.

IMPORTANT: Always refer to Form No. F_091699 - Care and Handling of Sprinklers. Also refer to Form No. F_080614 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking Technical Data, the appropriate standards of NFPA, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.

DESIGN CRITERIA - FM

FM Approval Requirements:

The Viking VK3021 Quick Response Pendent Sprinkler is FM Approved as standard response Non-Storage Pendent sprinkler as indicated in the FM Approval Guide. For specific application and installation requirements, reference the latest applicable FM Loss Prevention Data Sheets (including Data Sheet 2-0). FM Global Loss Prevention Data Sheets contain guidelines relating to, but not limited to: minimum water supply requirements, hydraulic design, ceiling slope and obstructions, minimum and maximum allowable spacing, and deflector distance below the ceiling.

NOTE: The FM Installation guidelines may differ from UL and/or NFPA criteria.

IMPORTANT: Always refer to Form No. F_091699 - Care and Handling of Sprinklers. Also refer to Form No. F_080614 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking Technical Data, the appropriate standards of NFPA, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.



TECHNICAL DATA

VK3021 QUICK RESPONSE PENDENT SPRINKLER (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058


Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

1. Install the escutcheon inner ring onto the sprinkler threads.



2. Carefully slide the wrench** sideways around the protective cap then push upwards to engage with the sprinkler wrench flats.

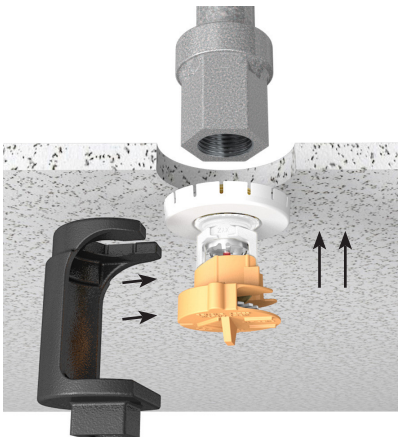

3. Install the sprinkler and escutcheon assembly into the pipe fitting. Be sure the escutcheon outer ring contacts the surface of the finished ceiling.


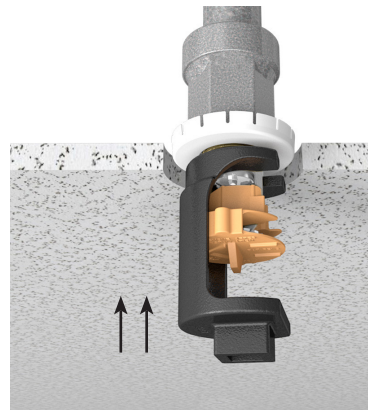


Figure 3: Recessed Installation (with Recessed Socket Wrench)

**A 1/2" ratchet is required (not available from Viking).

1. Install the escutcheon inner ring onto the sprinkler threads.

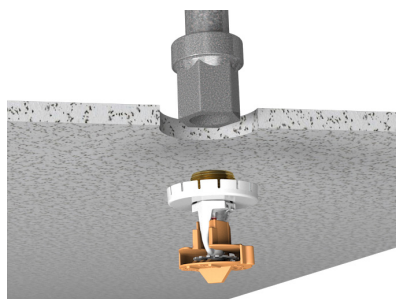

2. Carefully slide the wrench sideways around the protective cap then push upwards to engage with the sprinkler wrench flats.



3. Install the sprinkler and escutcheon assembly into the pipe fitting. Be sure the escutcheon outer ring contacts the surface of the finished ceiling.

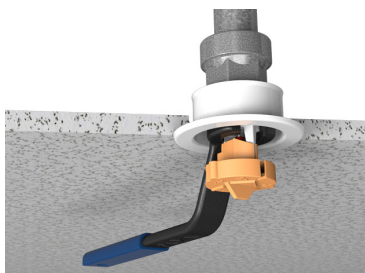


Figure 4: Recessed Installation (with standard Installer's Wrench)



TECHNICAL DATA

VK3021 QUICK RESPONSE PENDENT SPRINKLER (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058

Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

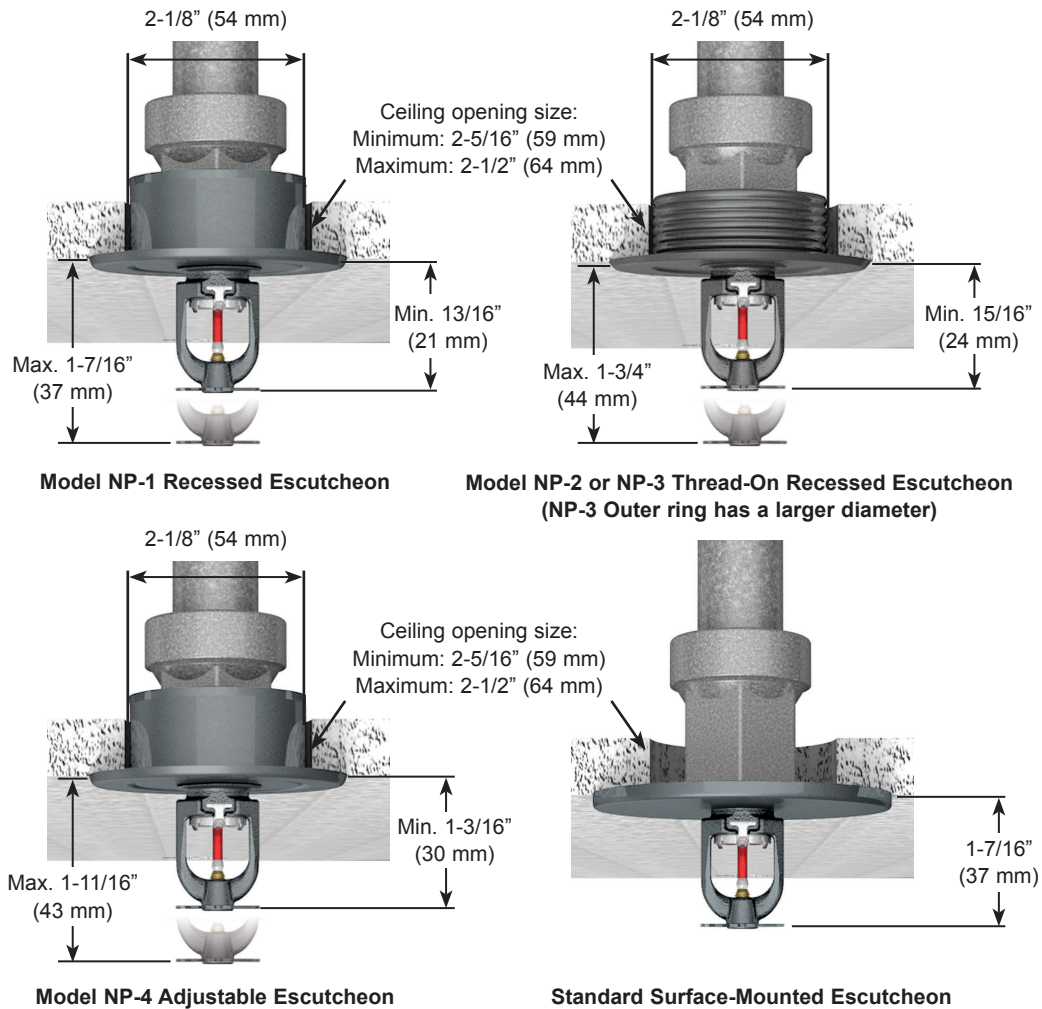


Figure 5: Installation Dimensions with Viking Escutcheons

Victaulic® VicFlex™ Sprinkler Fittings

Series AH2 and AH2-CC Braided Flexible Hoses



Series AH2



Series AH2-CC

1.0 PRODUCT DESCRIPTION

Available Sizes by Component

- **Series AH2 1"/DN25 Nominal ID Braided Hose:** 31"/790 mm, 36"/915 mm, 48"/1220 mm, 60"/1525 mm, 72"/1830 mm Note: length includes adapter nipple and 5.75"/146 mm straight reducer.
- **Series AH2-CC 1"/DN25 Nominal ID Braided Hose:** 31"/790 mm, 36"/915 mm, 48"/1220 mm, 60"/1525 mm, 72"/1830 mm Note: length includes captured coupling and 5.75"/146 mm straight reducer.

Connections

- **From Branchline**
 - ¾"/20 mm BSPT Female Thread (VdS only)
 - 1"/25 mm NPT or BSPT Female Thread
 - 1"/25 mm Grooved IGS (refer to [Publication 10.54](#) for additional IGS connections)
 - No. 116 CPVC Adapter (1"/25 mm Female CPVC Socket x 1"/25 mm Grooved IGS)
 - No. 142 Welded Outlet
 - Style 922 Outlet-T
 - Style 920N Mechanical-T Outlet
 - No. 65 Grooved End of Run Fitting
 - 1 ¼"/32 mm BSPT Female Thread (LPCB only)
- **Hose Inlet**
 - ¾"/20 mm BSPT Male Thread (VdS only)
 - 1"/25 mm Grooved IGS
 - 1"/25 mm NPT or BSPT Male Thread
 - 1 ¼"/32 mm BSPT Male Thread (LPCB only)
- **Sprinkler Reducer**
 - Sprinkler Connection: ½"/15 mm, ¾"/20 mm NPT or BSPT Female Thread
 - Straight Lengths: 5.75"/146 mm, 9"/230 mm, 13"/330 mm
 - 90° Elbows: Short elbows typically used with concealed sprinklers; Long elbows typically used with recessed pendent sprinklers.
 - Standard Short
 - Low-Profile Short
 - Standard Long
 - Low-Profile Long

ALWAYS REFER TO ANY NOTIFICATIONS AT THE END OF THIS DOCUMENT REGARDING PRODUCT INSTALLATION, MAINTENANCE OR SUPPORT.

1.0 PRODUCT DESCRIPTION (CONTINUED)

Brackets

- Style AB2 for suspended and hard-lid ceilings and sidewalls: allows for vertical sprinkler adjustment and installation before most ceiling tiles are in place
- Style AB3 for surface mount applications: wood, metal and block walls, or ceilings.
- Style AB4 for hard-lid ceilings with hat furring channel grid systems: allows for vertical sprinkler adjustment
- Style AB5 for hard-lid ceilings and sidewalls: allows for vertical sprinkler adjustment
- Style AB7 / Adjustable AB7 for suspended and hard-lid ceilings
- Style AB10 for Armstrong® TechZone™ ceilings
- Style AB11 for lay-in panel suspended t-grid ceilings or drywall suspended t-grid ceilings: allows for low-profile installation (use only with 90° low-profile elbows)
- Style AB12 for suspended and hard-lid ceilings: allows for vertical sprinkler adjustment, and allows for low-profile installation down to 4"/100 mm.
- Style ABBA bracket for suspended, exposed, and hard-lid ceilings
- Style ABMM bracket for surface mount and stand off-mount applications: wood, metal and block walls, or ceilings and hard-lid ceilings
- Strut channel and pipe clamp, not supplied by Victaulic

Maximum Working Temperature

- 225°F/107°C
- 150°F/65°C (No. 116 CPVC Adapter)

Maximum Working Pressure

- 200 psi/1375 kPa (FM)
- 175 psi/1206 kPa (cULus)
- 232 psi/1600 kPa (VdS/LPCB)
- 203 psi/1.4 MPa (CCC)
- 175 psi/1206 kPa (No. 116 CPVC Adapter)

Minimum Bend Radius

- 7"/178 mm (FM/CCC)
- 2"/51 mm (cULus)
- 3"/76.2 mm (VdS/LPCB)

Maximum Allowable Sprinkler K-Factors

- FM (½"/15 mm reducer) K5.6/8,1 (S.I.), (¾"/20 mm reducer) K14.0/20,2 (S.I.)
- cULus (½"/15 mm reducer) K8.0/11,5 (S.I.), (¾"/20 mm reducer) K14.0/20,2 (S.I.)
- VdS/LPCB (½"/15 mm reducer) K5.6/8,1 (S.I.), (¾"/20 mm reducer) K8.0/11,5 (S.I.)

2.0 CERTIFICATIONS/LISTINGS



NOTE

- The VicFlex™ Series AH2 Hose has been tested and evaluated by Spears® for acceptable use with Spears® CPVC Products and is therefore covered under the Spears® FlameGuard® Installer Protection Plan.

3.0 SPECIFICATIONS – MATERIAL

Series AH2:

Flexible Hose: 300-series Stainless Steel
Collar/Weld Fitting: 300-series Stainless Steel
Gasket Seal: Victaulic EPDM
Isolation Ring: Nylon
Nut and Nipple: Carbon Steel, Zinc-Plated
Reducer: Carbon Steel, Zinc-Plated
Low-Profile Elbows: Ductile Iron, Zinc-Plated or Carbon Steel, Zinc-Plated
Brackets: Carbon Steel, Zinc-Plated

Series AH2-CC:

Flexible Hose: 300-series Stainless Steel
Collar/Weld Fitting: 300-series Stainless Steel
Gasket Seal: Victaulic EPDM
Isolation Ring: Nylon
Coupling Retainer Ring: Polyethylene
Nut: Carbon Steel, Zinc-Plated
Reducer: Carbon Steel, Zinc-Plated
Low-Profile Elbows: Ductile Iron, Zinc-Plated or Carbon Steel, Zinc-Plated
Housing: Ductile Iron conforming to ASTM A 536, Grade 65-45-12. Ductile Iron conforming to ASTM A 395, Grade 65-45-15, is available upon special request.

Coupling Housing Coating:

- Orange Enamel (North America, Asia Pacific)
- Red Enamel (Europe)
- Hot Dipped Galvanized

Gasket¹:

Grade "E" EPDM (Type A)

FireLock EZ™ products have been Listed by Underwriters Laboratories Inc., Underwriters Laboratories of Canada Limited, and Approved by Factory Mutual Research for wet and dry (oil free air) sprinkler services within the rated working pressure.

¹ Services listed are General Service Guidelines only. It should be noted that there are services for which these gaskets are not compatible. Reference should always be made to the latest [Victaulic Seal Selection Guide](#) for specific gasket service guidelines and for a listing of services which are not compatible.

Bolts/Nut: Zinc electroplated carbon steel, trackhead meeting the physical and chemical requirements of ASTM A 449 and physical requirements of ASTM A 183.


Linkage: CrMo Alloy Steel zinc electroplated per ASTM B633 Zn/Fe 5, Type III Finish

No. 116 Adapter Fitting: CPVC and Brass

Seal: Victaulic EPDM

4.0 DIMENSIONS


Product Details - Series AH2 Braided Hose

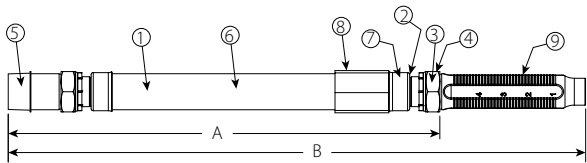

Item	Description
1	Flexible Hose
2	Isolation Ring
3	Gasket
4	Nut
5	Adapter Nipple
6	Braid
7	Collar/Weld Fitting
8	Sleeve
9	Reducer

Hose	Dimensions	
Series	A	B
	inches mm	inches mm
AH2-31	25.6 650	31.0 790
AH2-36	31.6 803	36.0 915
AH2-48	42.6 1082	48.0 1220
AH2-60	54.6 1387	60.0 1525
AH2-72	66.6 1692	72.0 1830

Series AH2-CC Braided Hose

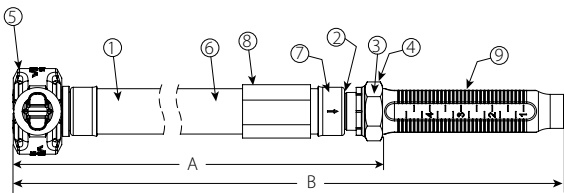

Item	Description
1	Flexible Hose
2	Isolation Ring
3	Gasket
4	Nut
5	Captured Coupling
6	Braid
7	Collar/Weld Fitting
8	Sleeve
9	Reducer

Hose	Dimensions	
Series	A	B
	inches mm	inches mm
AH2-CC-31	24.5 622	29.8 760
AH2-CC-36	29.5 749	34.8 885
AH2-CC-48	41.5 1054	46.8 1190
AH2-CC-60	53.5 1359	58.8 1495
AH2-CC-72	65.5 1664	70.8 1800

4.1 DIMENSIONS

Standard Reducer




5.75"/146 mm straight reducer

Optional Reducers




9.0"/230 mm straight reducer




13.0"/330 mm straight reducer

Standard Elbow Reducers

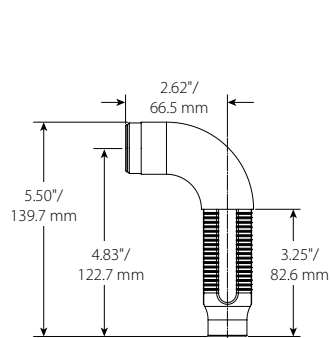


Short 90°
Elbow Reducer

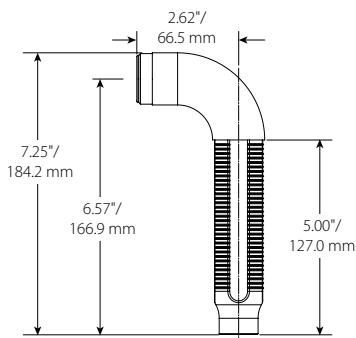


Long 90°
Elbow Reducer

Low-Profile Elbow Reducers



Short 90° Low-Profile
Elbow Reducer



Long 90° Low-Profile
Elbow Reducer


NOTES

- The Short 90° Elbow Reducer is typically used with concealed sprinklers while the Long 90° Elbow Reducer is typically used in the installation of recessed pendent sprinklers.
- FM/VdS/LPCB Approved only

NOTE

- Style AB11: When Low-Profile Elbows are used with the Style AB11 bracket, the Low-Profile Short Elbow is typically used with concealed sprinklers while the Low-Profile Long Elbow is typically used in the installation of recessed pendent sprinklers.

No. 116 CPVC Adapter



NOTES

- E to E is 3.0"/76.0 mm
- The No. 116 CPVC Adapter has 2 ft. (0.6 m) EQL of 1" Schedule 40 pipe.

4.2 DIMENSIONS

VicFlex™ Brackets


Style AB2

- Suspended Ceilings
- Hard-Lid Ceilings

Item	Description
1	24"/610 mm or 48"/1219 mm Square Bar
2	Patented Vertically Adjustable Center Bracket
3	End Bracket


NOTE

- Both sizes FM/VdS/LPCB Approved, cULus Listed

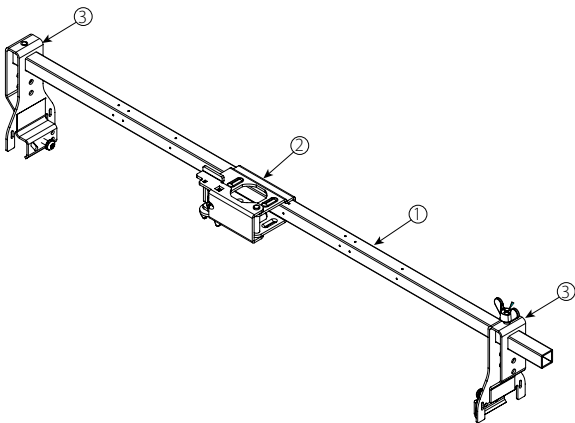

Style AB3

- Surface Mount Applications
- FM/LPCB Approved

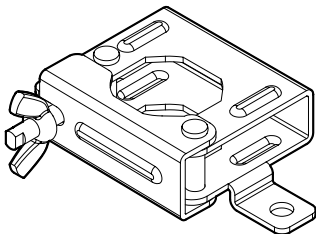


Style AB4

- Hard-Lid Ceilings with Hat Furring Channel Grid System

Item	Description
1	24"/610 mm or 48"/1219 mm Square Bar
2	Patented Vertically Adjustable Center Bracket
3	End Bracket for Hat Furring Channel

NOTE

- Both sizes FM/VdS/LPCB Approved, cULus Listed

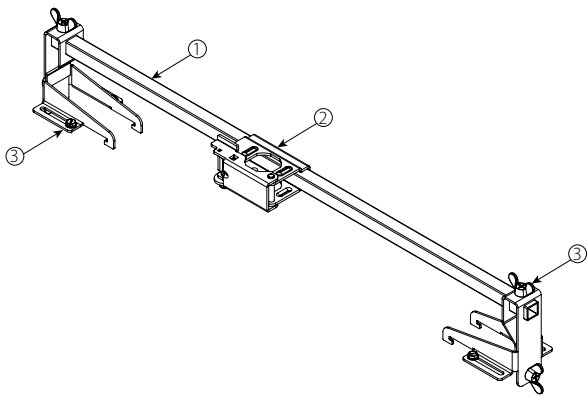

4.2 DIMENSIONS (CONTINUED)

VicFlex™ Brackets


Style AB5

- Hard-Lid Ceilings

Item	Description
1	24"/610 mm or 48"/1219 mm Square Bar
2	Patented Vertically Adjustable Center Bracket
3	End Bracket

NOTE

- Both sizes FM/VdS/LPCB Approved, cULus Listed

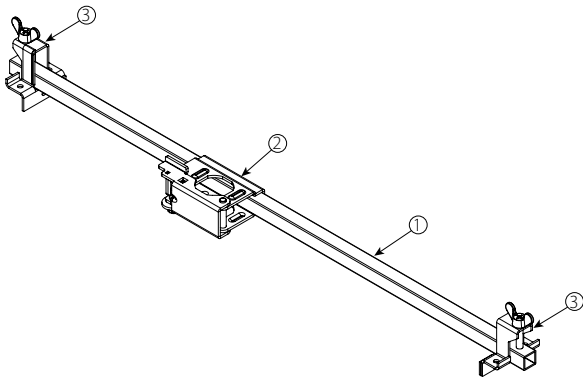


Style AB7

- Suspended Ceilings
- Hard-Lid Ceilings

Item	Description
1	24"/610 mm or 48"/1219 mm Square Bar
2	Patented 1-Bee2® Center Bracket
3	End Bracket

NOTE

- Both sizes FM/VdS/LPCB Approved

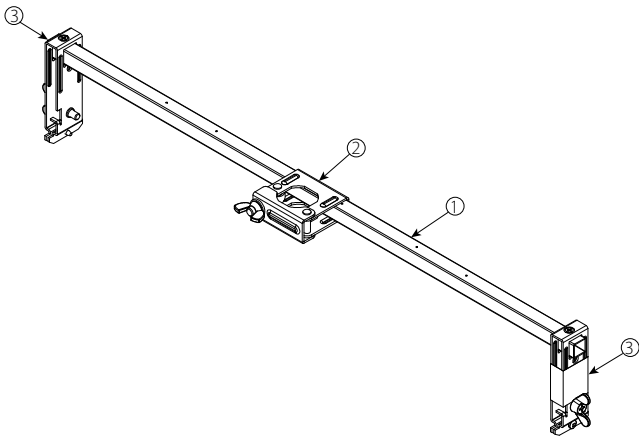


Style AB7 Adjustable

- Suspended Ceilings
- Hard-Lid Ceilings

Item	Description
1	700 mm or 1400 mm Square Bar
2	Patented 1-Bee2® Center Bracket
3	End Bracket (adjustable)

NOTE

- Both sizes FM/VdS/LPCB Approved

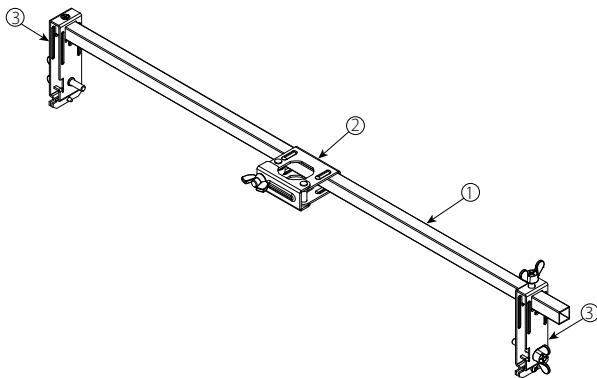


4.2 DIMENSIONS (CONTINUED)

VicFlex™ Brackets

Style AB10

- Suspended Ceilings
- Armstrong® TechZone™

Item	Description
1	6"/152mm Square Bar
2	Patented 1-Bee2® Center Bracket
3	End Bracket




NOTE

- FM/VdS/LPCB Approved, cULus Listed

Style AB11

- Suspended Ceilings
- Hard-Lid Ceilings

Item	Description
1	24"/610 mm or 48"/1219 mm Square Bar
2	Patented 1-Bee2® Center Bracket
3	End Bracket

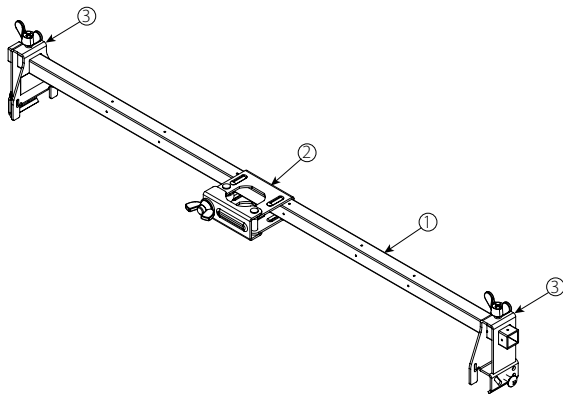


NOTE

- FM/VdS/LPCB Approved, cULus Listed

Style AB12

- Suspended Ceilings
- Hard-Lid Ceilings

Item	Description
1	Style AB12 Bracket Body
2	T25 Drive Set Screw

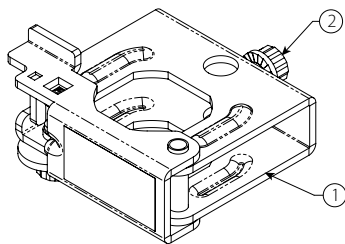

NOTE

- FM/VdS/LPCB Approved

4.2 DIMENSIONS (CONTINUED)

VicFlex™ Brackets


Style ABBA

- Floor-Above Mount
- Cantilever Mount
- Temporary Mount in Exposed Ceilings

Item	Description
1	Style ABBA Mounting Plate
2	Style ABBA Square Bar
3	Cap Screw, Serated Flange, M6 x 1 x 20, T25 Torx Drive Recessed
4	Style ABMM Bracket Body
5	Cap Screw, Serated Flange, M6 x 1 x 15.24, T25 Torx Drive Recessed

NOTE

- FM/LPCB Approved

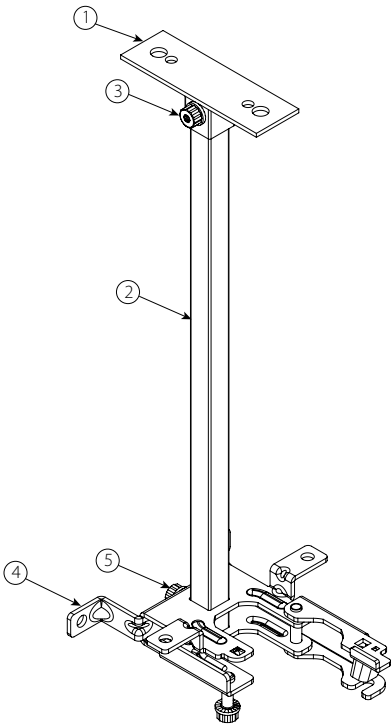


Style ABMM

- Surface Mount
- Stand-off Mount

Item	Description
1	Style ABMM Bracket Body
2	Cap Screw, Serated Flange, M6 x 1 x 15.24, T25 Torx Drive Recessed

NOTE


- FM/LPCB Approved

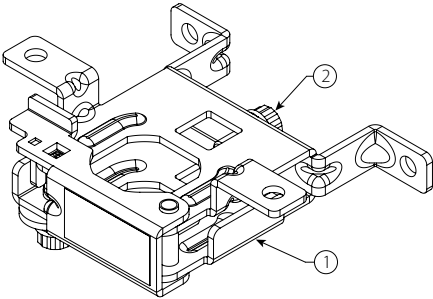

4.3 DIMENSIONS

Clearances

Series AH2 Braided Hose and Style AB2 Bracket with Suspended T-grid Ceilings

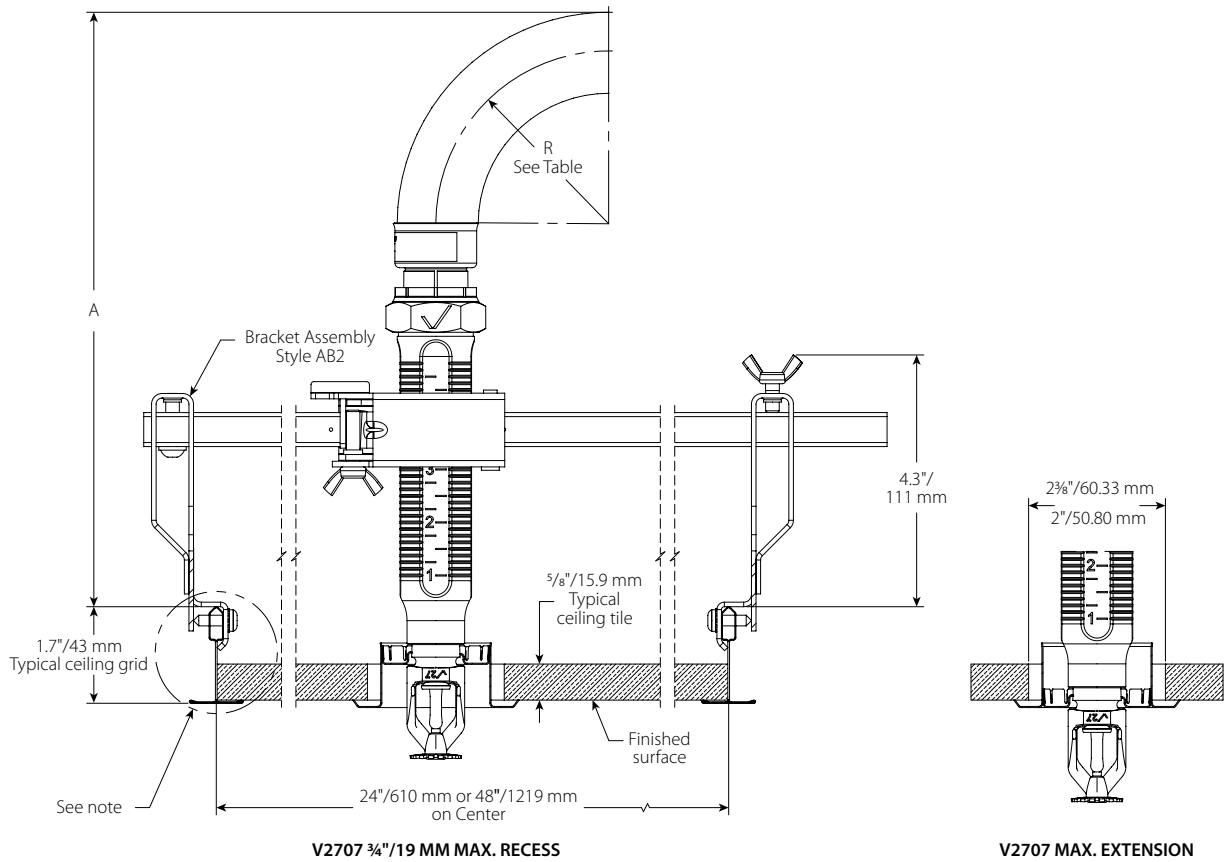

Dimension		Hose Clearance							
		Straight Reducer						Long Elbow	Short Elbow
		V2707 3/4" Max Recess inches mm	V3802 1/2" Max Recess inches mm	V2707 3/4" Max Recess inches mm	V3802 1/2" Max Recess inches mm	V2707 3/4" Max Recess inches mm	V3802 1/2" Max Recess inches mm	V2707 3/4" Max Recess inches mm	V3802 1/2" Max Recess inches mm
R	Bend Radius	2.0 51		3.0 76.2		7.0 178		—	
A	Minimum Required Installation Space	8.6 218	10.1 269	9.6 244	11.1 281	13.6 345	15.1 383	5.8 147	5.8 147


NOTE

- Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.

4.4 DIMENSIONS

Clearances

Series AH2 Braided Hose and Style AB2 Bracket with Wood/Metal Joist Ceilings

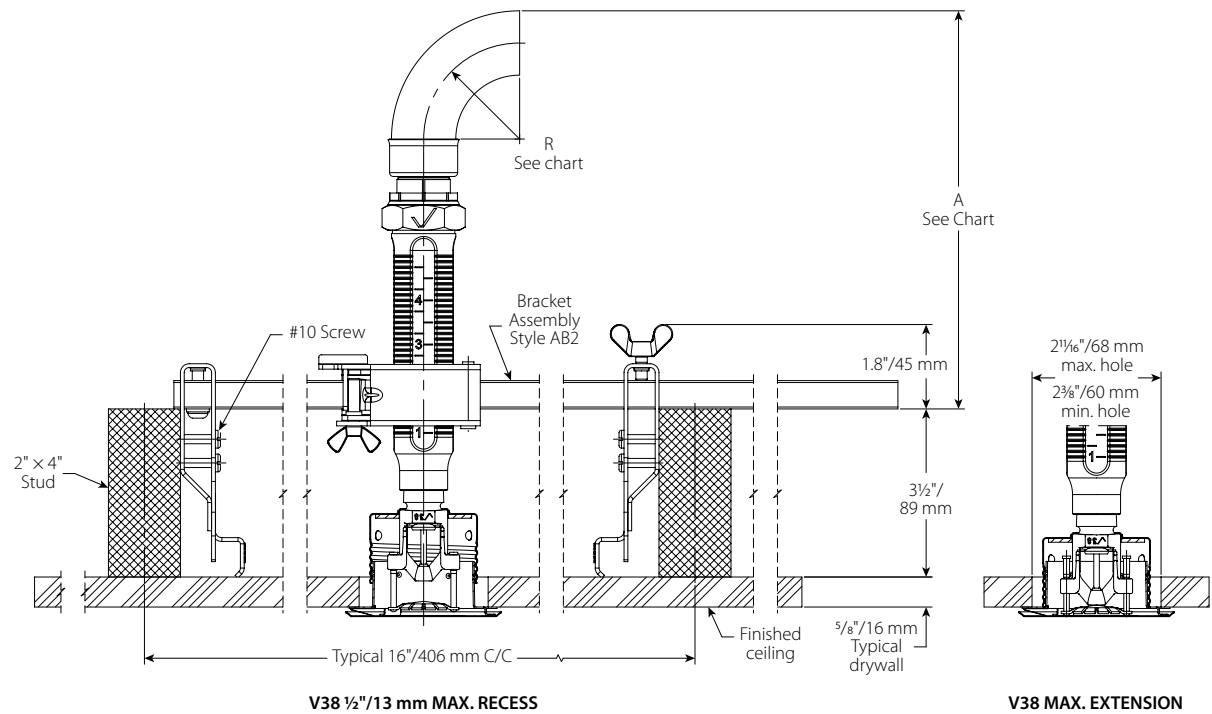


Dimension		Hose Clearance								
		Straight Reducer								
		V2707 ¾" / 20 mm Max Recess inches mm	V3802 ½" / 13 mm Max Recess inches mm	V2709 ¾" / 20 mm Sidewall inches mm	V2707 ¾" / 20 mm Max Recess inches mm	V3802 ½" / 13 mm Max Recess inches mm	V2709 ¾" / 20 mm Sidewall inches mm	V2707 ¾" / 20 mm Max Recess inches mm	V3802 ½" / 13 mm Max Recess inches mm	V2709 ¾" / 20 mm Sidewall inches mm
R	Bend Radius	2.0 50			3.0 80			7.0 175		
A	Minimum Required Installation Space	6.2 158	7.6 193	6.1 155	7.2 183	8.6 218	7.1 180	11.2 285	12.6 320	11.1 282

Dimension		Hose Clearance		
		Long Elbow		Short Elbow
		V2707 ¾" / 20 mm Max Recess inches mm	V2709 ¾" / 20 mm Sidewall inches mm	V3802 ½" / 13 mm Max Recess inches mm
R	Bend Radius	—		—
A	Minimum Required Installation Space	3.3 84	3.6 91	3.3 84

NOTE

- Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.

Series AH2 Braided Hose and Style AB4 Bracket with Hat Furring Channel Ceiling

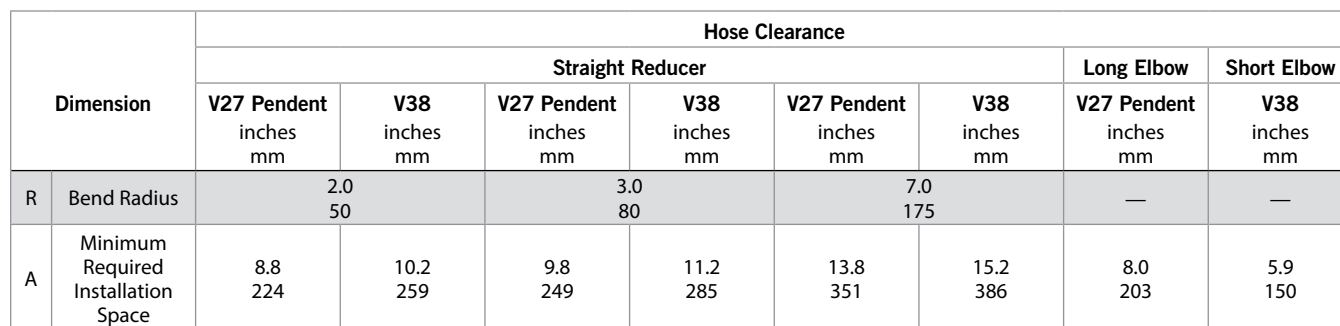


Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.

4.6 DIMENSIONS

Clearances

Series AH2 Braided Hose and Style AB5 Bracket with Metal Joist Ceiling

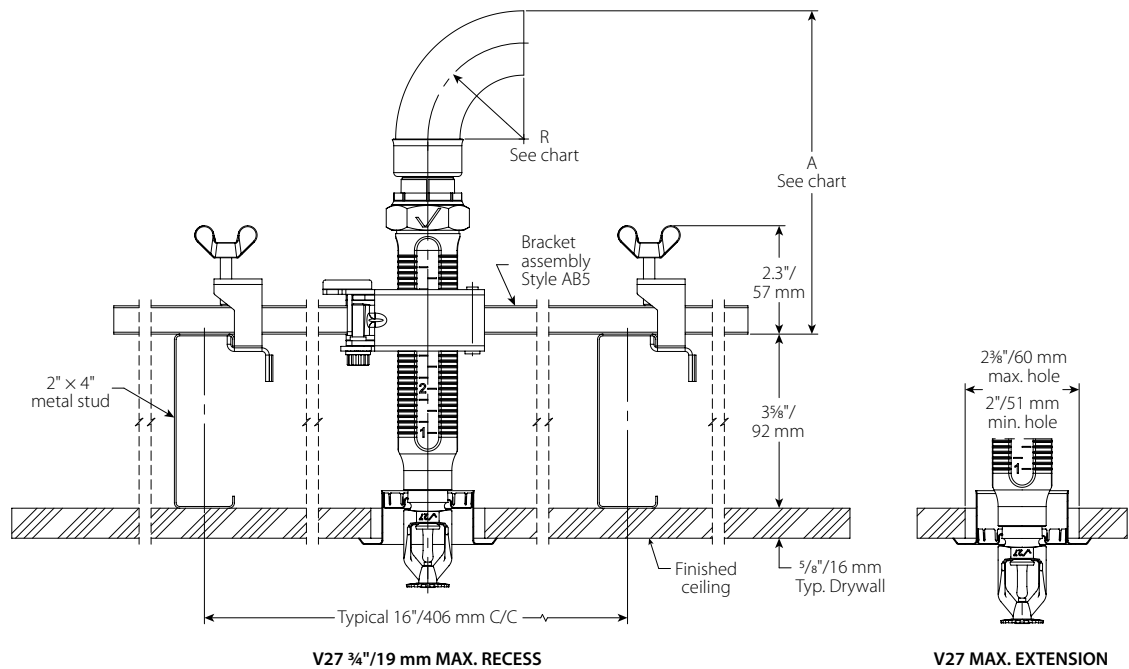

Dimension		Hose Clearance								
		Straight Reducer								
		"V2707 ¾" / 20 mm Max Recess inches mm	V3802 ½" / 13 mm Max Recess inches mm	V2709 ¾" / 20 mm Sidewall inches mm	V2707 ¾" / 20 mm Max Recess inches mm	V3802 ½" / 13 mm Max Recess inches mm	V2709 ¾" / 20 mm Sidewall inches mm	V2707 ¾" / 20 mm Max Recess inches mm	V3802 ½" / 13 mm Max Recess inches mm	V2709 ¾" / 20 mm Sidewall inches mm
R	Bend Radius	2.0 50			3.0 80			7.0 175		
A	Minimum Required Installation Space	6.0 158	7.7 196	6.1 155	7.0 178	8.7 221	7.1 180	11.0 279	12.7 323	11.1 282

Dimension		Hose Clearance				
		Long Elbow			Low-Profile Long Elbow	Short Elbow
		V2707 ¾" / 20 mm Max Recess inches mm	V3802 ½" / 13 mm Max Recess inches mm	V2709 ¾" / 20 mm Sidewall inches mm	V3802 ½" / 13 mm Max Recess inches mm	V3802 ½" / 13 mm Max Recess inches mm
R	Bend Radius	—			—	—
A	Minimum Required Installation Space	3.5 89	4.9 124	3.6 91	2.9 74	3.3 84


NOTE

- Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.

4.7 DIMENSIONS

Clearances

Series AH2 Braided Hose and Style AB11 Bracket (LOW-PROFILE SOLUTION) with Suspended T-Grid Ceilings

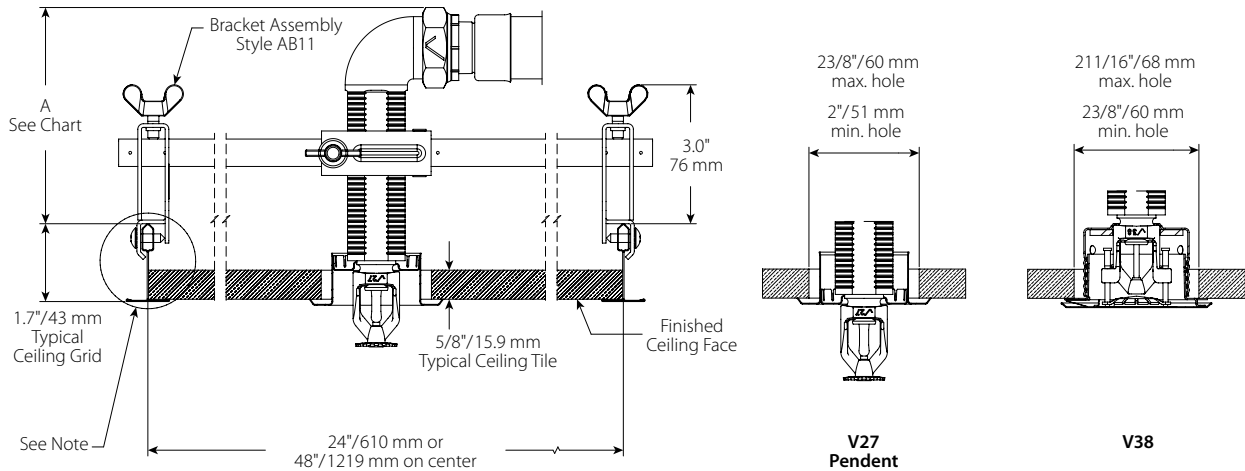

Dimension		Hose Clearance	
		Low-Profile Long Elbow	Low-Profile Short Elbow
		V2707 3/4" / 20 mm Max Recess" inches mm	V3802 1/2" / 13 mm Max Recess inches mm
A	Minimum Required Installation Space	4.0 102	3.9 99


NOTE

- Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.

4.8 DIMENSIONS

Clearances

Series AH2 Braided Hose and Style AB12 and ABBA Bracket

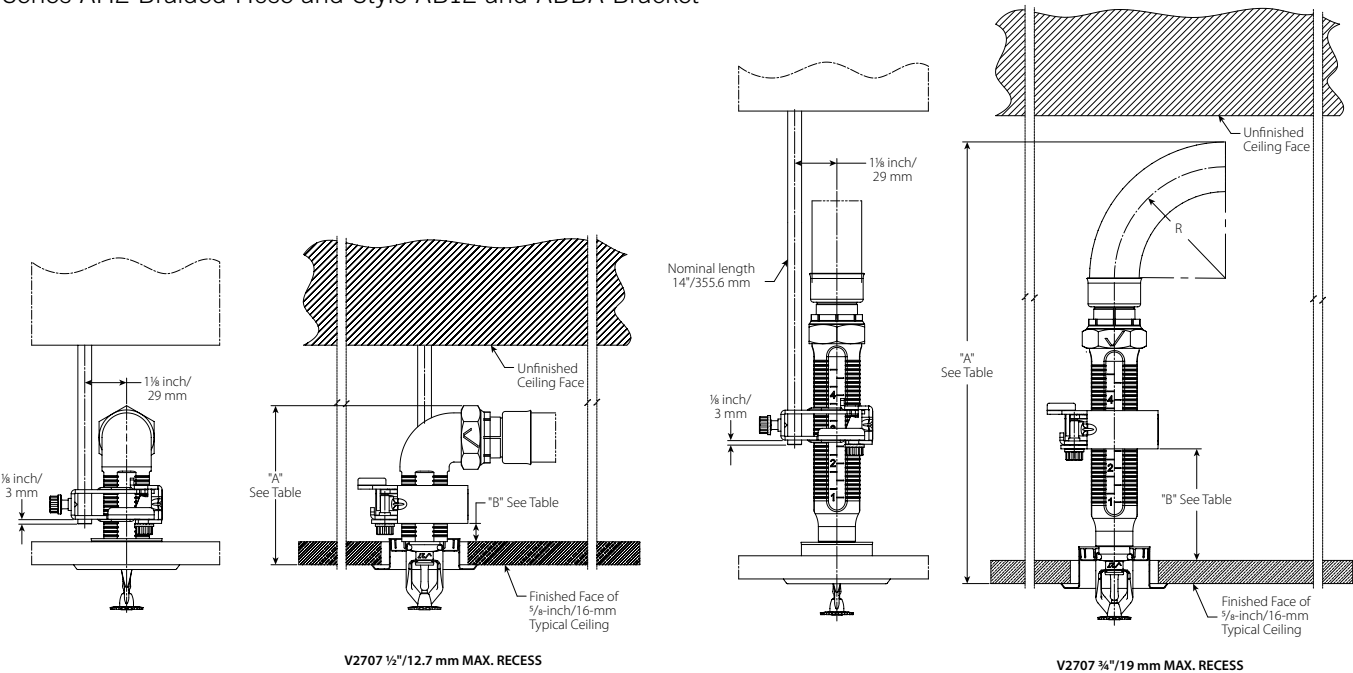

Dimension		Hose Clearance									
		Low-Profile Short Elbow		Low-Profile Long Elbow		Standard Short Elbow		Standard Long Elbow		Standard Straight Reducer	
		3/4"19 mm Recessed*	Concealed	3/4"19 mm Recessed	Concealed	3/4"19 mm Recessed	Concealed	3/4"19 mm Recessed	Concealed	3/4"19 mm Recessed	Concealed
		inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm
R	Bend Radius	—		—		—		—		7 175.0	
A	Minimum Required Installation Space	4.0 101.6	5.5 139.7	5.6 142.2	7.2 182.9	5.9 149.9	7.5 190.5	7.7 195.6	9.3 236.2	15.0 381.0	16.6 421.6
B	Distance from Top of Typical Ceiling Tile to Bottom of Gate	101.6 12.7	139.7 50.8	142.2 38.1	182.9 38.1	149.9 38.1	190.5 38.1	195.6 76.2	236.2 76.2	381.0 76.2	421.6 76.2

* Adjustability will be limited


NOTE

- For Style AB12 Bracket Sprinkler location relative to 3/8" threaded rod is 1 1/8"/29 mm center-to-center.
- Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.

4.9 DIMENSIONS

Stand-off Dimensions


Style ABMM Bracket

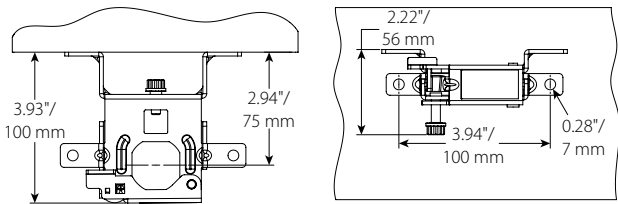

4.10 DIMENSIONS

Clearances

Series AH2 Braided Hose and Style AB3 and ABMM Bracket for Surface Mount Application

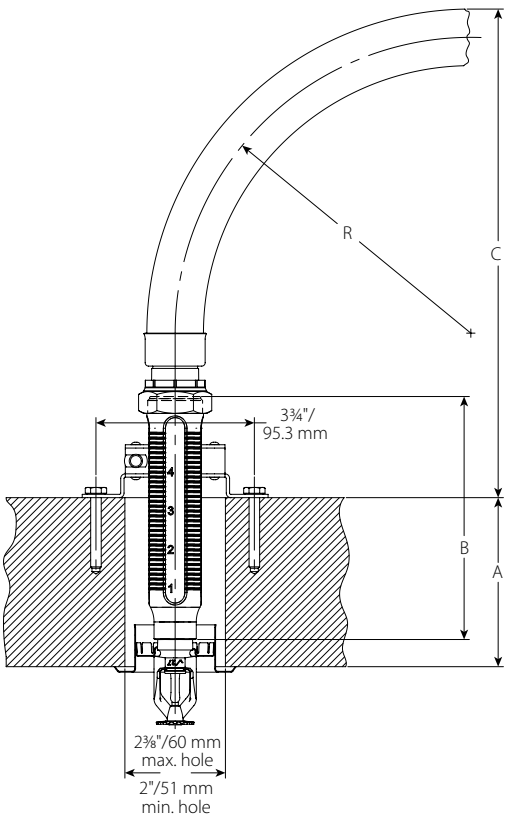

Dimension		Hose Clearance																	
		inches mm									inches mm								
R	Bend Radius	7 175									8 200								
A	Wall Thickness	2 50	4 100	6 150	8 200	10 250	2 50	4 100	6 150	8 200	10 250	2 50	4 100	6 150	8 200	10 250	2 50	4 100	6 150
B	Outlet Length	5.75 146.1	9 228.6	13 330.2	5.75 146.1	9 228.6	13 330.2	9 228.6	13 330.2	13 330.2	13 330.2	5.75 146.1	9 228.6	13 330.2	5.75 146.1	9 228.6	13 330.2	9 228.6	13 330.2
C	Distance from Top of Ceiling to Top of Hose	11.6 294	14.8 376	18.8 478	9.6 243	12.8 325	16.8 427	10.8 275	14.8 376	12.8 325	10.8 275	12.6 319	15.8 402	19.8 503	10.6 268	13.8 351	17.8 452	11.8 300	15.8 402


NOTE

- Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.
- See installation instructions for mounting screw type and size.


4.11 DIMENSIONS

Branchline Clearances

Series AH2 Braided Hose with Style 922 Threaded Outlet Series AH2-CC Braided Hose with Style 922 Grooved Outlet

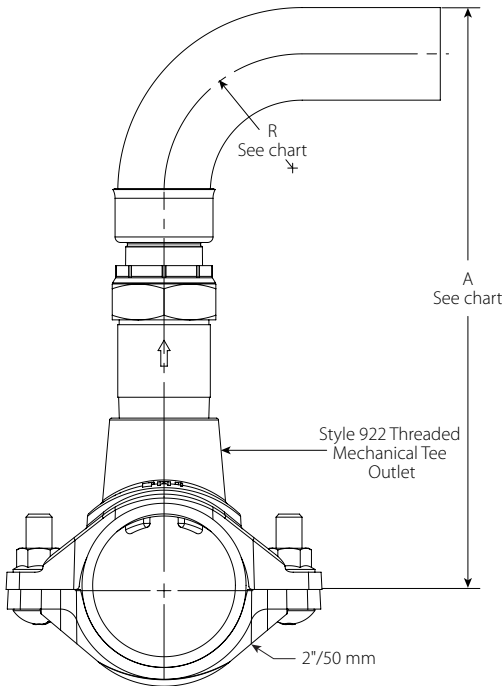

Dimension		Hose Clearance					
		inches mm					
R	Bend Radius	2 51	3 80	4 100	5 125	6 150	7 175
A	Min.	8.4 212	9.4 238	10.4 263	11.4 289	12.4 314	13.4 339

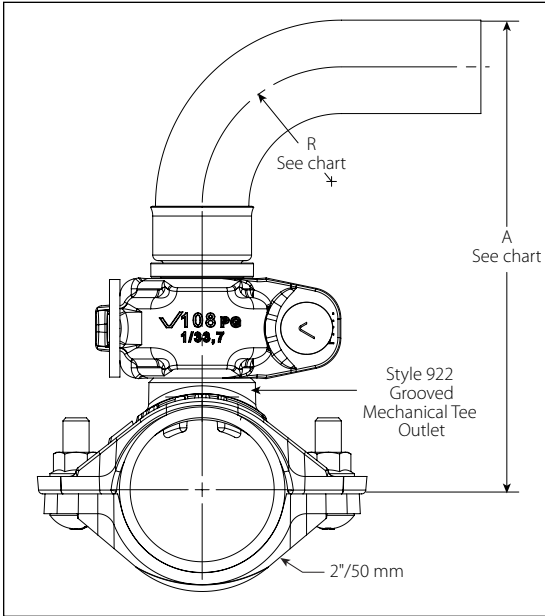


Dimension		Hose Clearance					
		inches mm					
R	Bend Radius	2 51	3 80	4 100	5 125	6 150	7 175
A	Min.	6.7 171	7.7 197	8.7 222	9.7 247	10.7 273	11.7 298

4.12 DIMENSIONS


Branchline Clearances

Series AH2 Braided Hose with Female Threaded Outlet

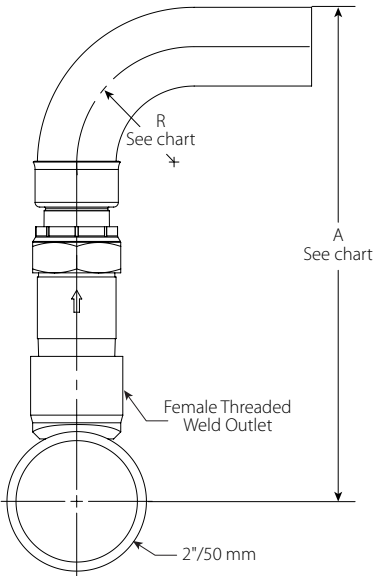

Dimension		Hose Clearance						
		inches mm						
R	Bend Radius	2 51	3 80	4 100	5 125	6 150	7 175	
A	Min.	8.4 214	9.4 239	10.4 264	11.4 290	12.4 315	13.41 341	

Series AH2-CC Braided Hose with Grooved Outlet

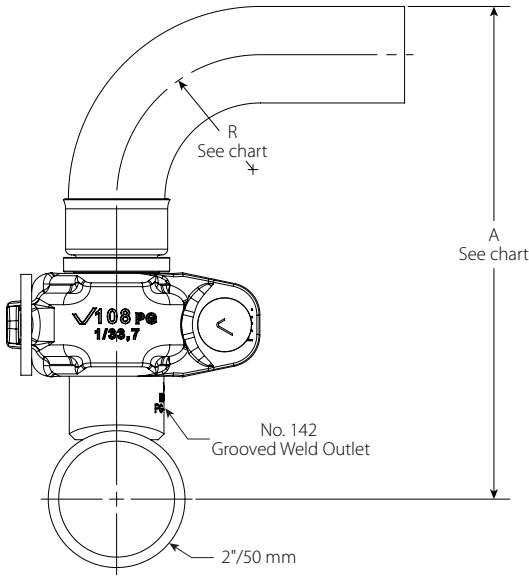

Dimension		Hose Clearance						
		inches mm						
R	Bend Radius	2 51	3 80	4 100	5 125	6 150	7 175	
A	Min.	7.1 180	8.1 205	9.1 231	10.1 256	11.1 281	12.1 307	

5.0 PERFORMANCE – FRICTION LOSS DATA



Series AH2 and AH2-CC Braided Hoses with Straight 5.75"/146 mm Reducers Style AB2, AB4, AB5 and AB10 VicFlex™ Brackets

Hose Length inches mm	Reducer		UL	
	Type	Nominal Outlet Size inches DN	Equivalent Length of 1"/33.7mm Sch. 40 pipe feet meters	Maximum Bends
31 790	Straight	½ DN15	15.0 4.6	3
			16.0 4.9	4
		¾ DN20	19.0 5.8	3
			20.0 6.1	4
36 915	Straight	½ DN15	18.0 5.5	3
			21.0 6.4	5
		¾ DN20	21.0 6.4	3
			23.0 7.0	5
48 1220	Straight	½ DN15	21.0 6.4	3
			32.0 9.8	8
		¾ DN20	26.0 7.9	3
			37.0 11.3	8
60 1525	Straight	½ DN15	27.0 8.2	3
			46.0 14.0	10
		¾ DN20	27.0 8.2	3
			46.0 14.0	10
72 1830	Straight	½ DN15	31.0 9.4	3
			55.0 16.8	12
		¾ DN20	30.0 9.1	3
			60.0 18.3	12


5.1 PERFORMANCE – FRICTION LOSS DATA



Series AH2 and AH2-CC Braided Hoses with 90° Low-Profile Elbow
Style AB11 VicFlex™ Bracket

Hose Length inches mm	Reducer		UL	
	Type	Nominal Outlet Size inches DN	Equivalent Length of 1"/33.7mm Sch. 40 pipe feet meters	Maximum Bends
31 790	LP Elbow	1/2 DN15	18.0 5.5	3
			24.0 7.3	4
		3/4 DN20	21.0 6.4	3
			24.0 7.3	4
36 915	LP Elbow	1/2 DN15	19.0 5.8	3
			26.0 7.9	5
		3/4 DN20	23.0 7.0	3
			28.0 8.5	5
48 1220	LP Elbow	1/2 DN15	23.0 7.0	3
			43.0 13.1	8
		3/4 DN20	30.0 9.1	3
			42.0 12.8	8
60 1525	LP Elbow	1/2 DN15	28.0 8.5	3
			49.0 14.9	10
		3/4 DN20	31.0 9.4	3
			50.0 15.2	10
72 1830	LP Elbow	1/2 DN15	31.0 9.4	3
			65.0 19.8	12
		3/4 DN20	36.0 11.0	3
			63.0 19.2	12

5.2 PERFORMANCE – FRICTION LOSS DATA

<div>  Series AH2 and AH2-CC Braided Hoses Equivalent Length Design Guide </div>											
Hose		Equivalent Length of 1"/33.7 mm Sch. 40 pipe									
Length inches mm	Nominal Outlet Size inches DN	3 Bends feet meters	4 Bends feet meters	5 Bends feet meters	6 Bends feet meters	7 Bends feet meters	8 Bends feet meters	9 Bends feet meters	10 Bends feet meters	11 Bends feet meters	12 Bends feet meters
31 790	1/2 DN15	15.0 4.6	16.0 4.9	–	–	–	–	–	–	–	–
	3/4 DN20	19.0 5.8	20.0 6.1								
36 915	1/2 DN15	18.0 5.5	20.0 6.1	–	–	–	–	–	–	–	–
	3/4 DN20	21.0 6.4	22.0 6.7								
48 1220	1/2 DN15	21.0 6.4	24.0 7.3	26.0 7.9	28.0 8.5	30.0 9.1	32.0 9.8	–	–	–	–
	3/4 DN20	26.0 7.9	29.0 8.8	31.0 9.4	33.0 10.1	35.0 10.7	37.0 11.3				
60 1525	1/2 DN15	27.0 8.2	30.0 9.1	33.0 10.1	36.0 11.0	38.0 11.6	41.0 12.5	44.0 13.4	46.0 14.0	–	–
	3/4 DN20	27.0 8.2	30.0 9.1	33.0 10.1	36.0 11.0	38.0 11.6	41.0 12.5	44.0 13.4	46.0 14.0		
72 1830	1/2 DN15	31.0 9.4	34.0 10.4	37.0 11.3	39.0 11.9	42.0 12.8	45.0 13.7	47.0 14.3	50.0 15.2	53.0 16.2	55.0 16.8
	3/4 DN20	30.0 9.1	34.0 10.4	37.0 11.3	40.0 12.2	44.0 13.4	47.0 14.3	50.0 15.2	54.0 16.5	57.0 17.4	60.0 18.3

NOTES

- Values at 2"/51 mm center line bend radius for use with 5.75"/146 mm straight reducers

How to use this Design Guide:

- For some systems, it may be advantageous for the designer to calculate the system hydraulics using shorter equivalent lengths associated with fewer than the maximum allowable number of bends. In this case, the designer may select a design number of bends for the job and use the associated equivalent length from the design guide to determine the system hydraulics.
- It is possible that the actual installed condition of some of the flexible drops may have more bends than the designer selected. When this happens, the design guide may be used to find equivalent lengths based on the actual installed number of bends for particular sprinkler installations. The system hydraulics can be recalculated using actual equivalent lengths to verify the performance of the system.

5.3 PERFORMANCE – FRICTION LOSS DATA



Series AH2 and AH2-CC Braided Hoses

Style AB2, AB3, AB4, AB5, AB7, AB7 Adj., AB8, AB10, AB12, ABBA and ABMM VicFlex™ Brackets

Hose	Sprinkler	Reducer		FM	
Length inches mm	K-factor Imperial S.I.	Nominal Outlet Size inches DN	Type	Equivalent Length of 1"/33.7 mm Sch. 40 Pipe feet meters	Maximum Bends
31 790	5.6 8.1	½ DN15	Straight	13.8 4.2	2
			Elbow	23.5 7.2	
	8.0 11.5	¾ DN20	Straight	16.8 5.1	
			Elbow	16.8 5.1	
	11.2 16.1	¾ DN20	Straight	16.5 5.0	
			Elbow	17.8 5.4	
	14.0 20.2	¾ DN20	Straight	14.9 4.5	
			Elbow	15.5 4.7	
36 915	5.6 8.1	½ DN15	Straight	16.6 5.1	2
			Elbow	25.6 7.8	
	8.0 11.5	¾ DN20	Straight	20.0 6.1	
			Elbow	19.7 6.0	
	11.2 16.1	¾ DN20	Straight	19.5 5.9	
			Elbow	20.7 6.3	
	14.0 20.2	¾ DN20	Straight	19.4 5.9	
			Elbow	19.6 6.0	
48 1220	5.6 8.1	½ DN15	Straight	23.4 7.1	3
			Elbow	30.7 9.4	
	8.0 11.5	¾ DN20	Straight	27.8 8.5	
			Elbow	26.6 8.1	
	11.2 16.1	¾ DN20	Straight	26.7 8.1	
			Elbow	27.9 8.5	
	14.0 20.2	¾ DN20	Straight	30.3 9.2	
			Elbow	29.5 9.0	

FM NOTES

- The Series AH2 and AH2-CC hoses have been tested and Approved by FM Global for use in wet, dry and preaction systems per NFPA 13, 13R, and 13D and FM data sheets 2-0, 2-5, and 2-8. FM 1637 standard for safety include, but are not limited to, pressure cycling, corrosion resistance, flow characteristics, vibration resistance, leakage, mechanical and hydrostatic strength.
- EXAMPLE: A 48-inch hose installed with two 30° bends and two 90° bends is permitted and considered equivalent to the data in the table shown above. In this example, the total number of degrees is 240°, which is less than the allowable 270°.

5.3 PERFORMANCE – FRICTION LOSS DATA (CONTINUED)



Series AH2 and AH2-CC Braided Hoses

Style AB2, AB3, AB4, AB5, AB7, AB7 Adj., AB8, AB10, AB12, ABBA and ABMM VicFlex™ Brackets

Hose	Sprinkler	Reducer		FM	
Length inches mm	K-factor Imperial S.I.	Nominal Outlet Size inches DN	Type	Equivalent Length of 1"/33.7 mm Sch. 40 Pipe feet meters	Maximum Bends
60 1525	5.6 8.1	½ DN15	Straight	30.2 9.2	4
			Elbow	35.9 10.9	
	8.0 11.5	¾ DN20	Straight	35.7 10.9	
			Elbow	33.6 10.2	
	11.2 16.1	¾ DN20	Straight	33.9 10.3	
			Elbow	35.0 10.7	
	14.0 20.2	¾ DN20	Straight	33.9 10.3	
			Elbow	34.1 10.4	
72 1830	5.6 8.1	½ DN15	Straight	37.0 11.3	4
			Elbow	41.1 12.5	
	8.0 11.5	¾ DN20	Straight	43.5 13.3	
			Elbow	40.6 12.4	
	11.2 16.1	¾ DN20	Straight	41.3 12.6	
			Elbow	42.2 12.9	
	14.0 20.2	¾ DN20	Straight	37.5 11.4	
			Elbow	38.6 11.8	

FM NOTES

- The Series AH2 and AH2-CC hoses have been tested and Approved by FM Global for use in wet, dry and preaction systems per NFPA 13, 13R, and 13D and FM data sheets 2-0, 2-5, and 2-8. FM 1637 standard for safety include, but are not limited to, pressure cycling, corrosion resistance, flow characteristics, vibration resistance, leakage, mechanical and hydrostatic strength.
- EXAMPLE: A 48-inch hose installed with two 30° bends and two 90° bends is permitted and considered equivalent to the data in the table shown above. In this example, the total number of degrees is 240°, which is less than the allowable 270°.

5.4 PERFORMANCE – FRICTION LOSS DATA


Series AH2 and AH2-CC Braided Hoses with 90° Low-Profile Elbows
Style AB5, AB11, AB12, ABBA and ABMM VicFlex™ Brackets

Hose	Reducer		Sprinkler	FM	
Length inches mm	Type	Nominal Outlet Size inches DN	K-factor Imperial S.I.	Equivalent Length of 1"/33.7mm Sch. 40 pipe feet meters	Maximum Bends
31 790	LP Elbow	1/2 DN15	5.6	13.7	2
			8.1	4.2	
		3/4 DN20	8.0	13.6	
			11.5	4.14	
			11.2	13.7	
			16.1	4.2	
36 915	LP Elbow	1/2 DN15	5.6	17.0	2
			8.1	5.2	
		3/4 DN20	8.0	16.9	
			11.5	5.2	
			11.2	17.0	
			16.1	5.2	
48 1220	LP Elbow	1/2 DN15	5.6	25.0	3
			8.1	7.6	
		3/4 DN20	8.0	27.8	
			11.5	8.5	
			11.2	24.9	
			16.1	7.6	
60 1525	LP Elbow	1/2 DN15	5.6	33.0	4
			8.1	10.1	
		3/4 DN20	8.0	32.6	
			11.5	9.9	
			11.2	32.9	
			16.1	10.0	
72 1830	LP Elbow	1/2 DN15	5.6	41.1	4
			8.1	12.5	
		3/4 DN20	8.0	40.6	
			11.5	12.4	
			11.2	40.9	
			16.1	12.5	
	LP Elbow	1/2 DN15	5.6	40.7	
			8.1	12.4	
		3/4 DN20	14.0		
			20.2		
			20.2		
			20.2		

FM NOTES

- The Series AH2 and AH2-CC hoses have been tested and Approved by FM Global for use in wet, dry and preaction systems per NFPA 13, 13R, and 13D and FM data sheets 2-0, 2-5, and 2-8. FM 1637 standard for safety include, but are not limited to, pressure cycling, corrosion resistance, flow characteristics, vibration resistance, leakage, mechanical and hydrostatic strength.
- EXAMPLE: A 48-inch hose installed with two 30° bends and two 90° bends is permitted and considered equivalent to the data in the table shown above. In this example, the total number of degrees is 240°, which is less than the allowable 270°.

5.5 PERFORMANCE – FRICTION LOSS DATA



Series AH2 and AH2-CC Braided Hoses
Style AB2, AB4, AB5, AB7, AB7 Adj., AB8, AB10, AB11 and AB12 VicFlex™ Brackets

Hose	Reducer	VdS	
Length mm inches	Nominal Outlet Size DN inches	Equivalent Length according to EN 10255 DN25 (33.7 x 3.25 mm) meters feet	Maximum Bends
790 31	DN15 ½	5.5 18.0	3
	DN20 ¾		
915 36	DN15 ½	6.4 21.0	3
	DN20 ¾		
1220 48	DN15 ½	8.5 27.9	3
	DN20 ¾		
1525 60	DN15 ½	10.7 35.1	4
	DN20 ¾		
1830 72	DN15 ½	12.8 42.0	4
	DN20 ¾		

VDS CEILING MANUFACTURERS LIST

AB2, AB7, AB10, AB11, AB12

1. AMF
2. Armstrong
3. Chicago Metallic
4. Dipling
5. Durlum
6. Geipel
7. Gema-Armstrong
8. Hilti
9. Knauf
10. Lafarge
11. Linder
12. Odenwald
13. Richter
14. Rigips
15. Rockfon Pagos
16. Suckow & Fischer
17. USG Donn

AB4

No specific approval

AB5

1. Hilti
2. Knauf
3. Lafarge
4. Lindner
5. Rigips

5.6 PERFORMANCE – FRICTION LOSS DATA



LPS 1261 Issue 1.2
Cert/LPCB Ref. 104/02
104/03

Series AH2 and AH2-CC Braided Hoses Style AB2, AB3, AB4, AB5, AB7, AB8 and AB10 VicFlex™ Brackets

Hose	Reducer	LPCB	
Length mm inches	Nominal Outlet Size DN inches	Equivalent Length according to EN 10255 DN25 (33.7 x 3.25 mm) meters feet	Maximum Bends
790 31	DN15 ½	1.8 6.0	2
	DN20 ¾		
915 36	DN15 ½	3.6 11.9	3
	DN20 ¾		
1220 48	DN15 ½	4.3 14.0	3
	DN20 ¾		
1525 60	DN15 ½	4.1 13.6	3
	DN20 ¾		
1830 72	DN15 ½	5.5 18.1	3
	DN20 ¾		

5.7 PERFORMANCE – FRICTION LOSS DATA



Series AH2 Braided Hose

Hose	CCC	
Length mm inches	Equivalent Length of 1"/33.7mm Sch. 40 pipe according to G5135.16 tested at 114 lpm (30 gpm)	
	Straight Configuration meters feet	Bend Configuration meters feet
790 31	0.87 2.9	2.70 8.9
	1.00 3.3	2.80 9.2
915 36	1.00 3.3	2.80 9.2
	1.00 3.3	2.80 9.2
1220 48	2.23 7.3	4.66 15.3
	2.23 7.3	4.66 15.3
1525 60	2.90 9.5	6.5 21.3
	2.90 9.5	6.5 21.3
1830 72	3.31 10.9	7.16 23.5
	3.31 10.9	7.16 23.5

6.0 NOTIFICATIONS

⚠ WARNING



- Read and understand all instructions before attempting to install any Victaulic products.
- Always verify that the piping system has been completely depressurized and drained immediately prior to installation, removal, adjustment, or maintenance of any Victaulic products.
- Wear safety glasses, hardhat, and foot protection.

Failure to follow these instructions could result in death or serious personal injury and property damage.

- These products shall be used only in fire protection systems that are designed and installed in accordance with current, applicable National Fire Protection Association (NFPA) standards, or equivalent local and national fire protection standards, and in accordance with applicable building and fire codes. These standards and codes contain important information regarding protection of systems from freezing temperatures, corrosion, mechanical damage, etc.
- The installer shall understand the use of this product and why it was specified for the particular application.
- The installer shall understand common industry safety standards and potential consequences of improper product installation.
- It is the system designer's responsibility to verify suitability of materials for use with the intended fluid media within the piping system and external environment.
- The material specifier shall evaluate the internal and external effect of chemical composition, pH level, operating temperature, chloride level, oxygen level, and flow rate on materials to confirm system life will be acceptable for the intended service.
- It is the responsibility of the owner of a building or their authorized agent to provide the sprinkler system installer with any knowledge that the water supply might be contaminated with or conducive to the development of microbiologically influenced corrosion (MIC), including as required by NFPA 13. Failure to identify adverse water quality issues may affect the *VicFlex* product and void the manufacturer's warranty.

Failure to follow installation requirements and local and national codes and standards could compromise system integrity or cause system failure, resulting in death or serious personal injury and property damage.

Victaulic VicFlex™ Braided Hoses may be painted/coated or caulked around, including fire barrier sealant, provided that the substance is compatible with stainless steel and zinc-plated carbon steel or ductile iron. Care shall be taken to ensure that the sprinkler and associated components do not come into contact with paint/coatings and caulking.

Victaulic VicFlex™ Braided Hoses that penetrate through non-fire rated gypsum wall (drywall) will function as designed, provided the components are installed in accordance with the respective installation instructions referenced in this document.

7.0 REFERENCE MATERIALS – CHARACTERISTICS

VicFlex™ Maximum Load Values

Series AH2 Hose with 24" Bracket

Hose Length inches mm	Total Load		Maximum Uniform Load	
	lb	N	lb/linear ft	N/linear m
31 790	5.2	23	2.6	38
36 915	5.5	25	2.8	40
48 1220	6.3	28	3.1	46
60 1525	7.0	31	3.5	51
72 1830	7.7	34	3.9	57

Series AH2 Hose with 48" Bracket

Hose Length inches mm	Total Load		Maximum Uniform Load	
	lb	N	lb/linear ft	N/linear m
31 790	6.1	27	1.5	22
36 915	6.4	29	1.6	23
48 1220	7.2	32	1.8	26
60 1525	7.9	35	2.0	29
72 1830	8.7	39	2.2	32

Total Load is defined as the sum of the weights of the following:

- Water-filled flexible sprinkler hose with threaded end fittings, including a typical fire sprinkler
- Bracket assembly (any applicable Victaulic bracket model of the relevant associated size)


ASTM C 635: Suspension System Load-Carrying Capabilities (excerpted)

Suspension System	Actual Length ft/m	Minimum Allowable Uniform Load	
		lb/linear ft	N/linear m
Direct Hung	Light	5.0	75.7
	Intermediate	12.0	181.0
	Heavy	16.0	241.7

SUMMARY: All direct-hung suspension system duty classifications per ASTM C 635 are able to withstand the maximum water-filled weight of the *VicFlex* sprinkler hose and bracket.

7.0 REFERENCE MATERIALS – CHARACTERISTICS (CONTINUED)

Flexible Hose In-Plane Bend Characteristics

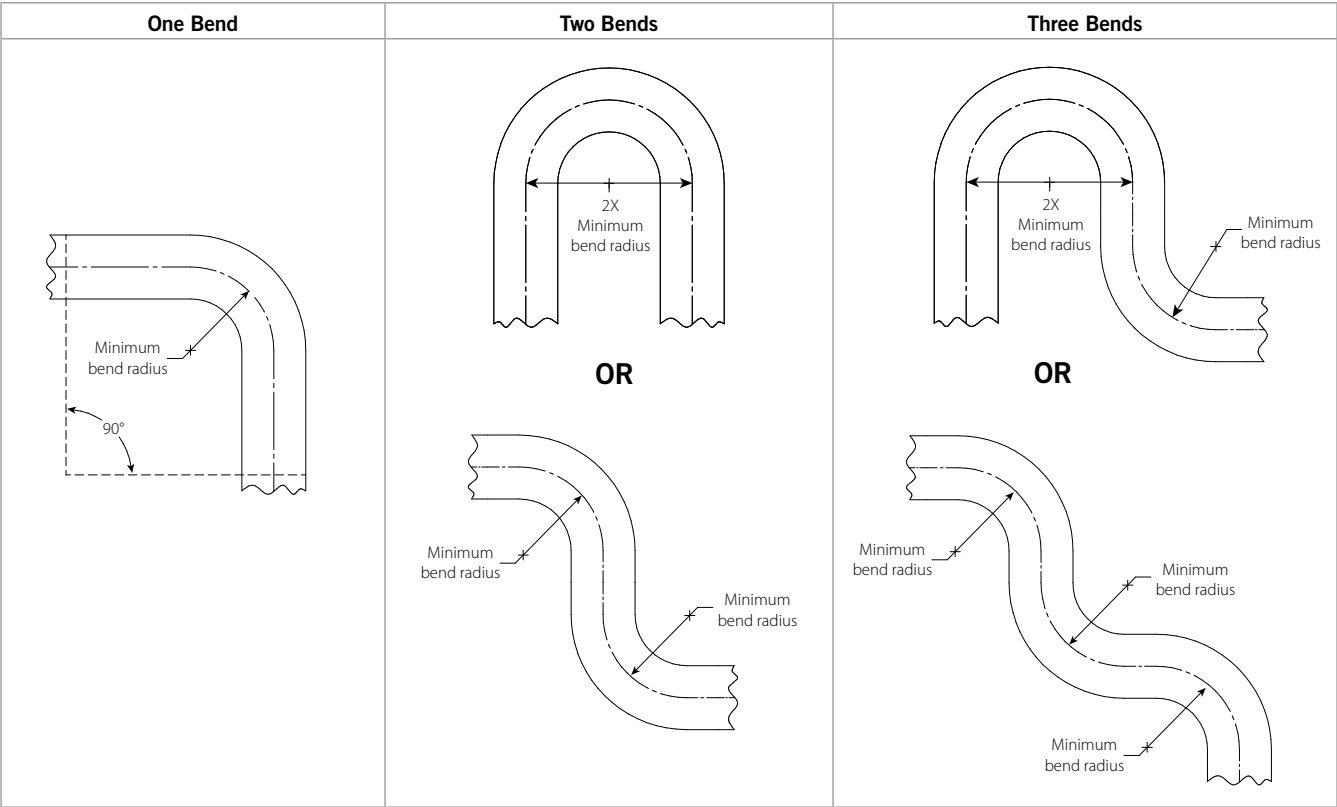

NOTE

- For out-of-plane (three-dimensional) bends, care must be taken to avoid imparting torque on the hose.

[I-VICFLEX: Field Installation Handbook](#)
[I-RES: Field Installation Handbook](#)

User Responsibility for Product Selection and Suitability
Each user bears final responsibility for determining the suitability of Victaulic products for their end-use application, in accordance with industry standards, project specifications, and Victaulic’s published performance, maintenance, and safety data, as well as all warnings and installation instructions. Nothing in this or any other document, nor any verbal recommendation, advice, or opinion from any Victaulic employee, shall be deemed to alter, vary, supersede, or waive any provision of Victaulic Company’s standard conditions of sale, warranty, installation instructions, or this disclaimer.

Installation
Always refer to and follow the [Victaulic Installation Handbook](#) or installation instructions for the product you are installing. Handbooks are included with each shipment of Victaulic products, providing complete installation and assembly data, and are available in PDF format on our website at victaulic.com.

Warranty
Refer to the Warranty section of the current Price List or contact Victaulic for details.

Intellectual Property Rights
No statement concerning the use of any material, product, service, or design is intended, or should be construed, to grant any license under any patent or other intellectual property right of Victaulic or any of its affiliates, or as a recommendation for the use of such material, product, service, or design in the infringement of any patent or other intellectual property right. The terms “Patented” or “Patent Pending” refer to design or utility patents or patent applications for articles and/or methods of use in the United States and/or other countries. Victaulic and all other Victaulic marks are the trademarks or registered trademarks of Victaulic Company, and/or its affiliated entities, in the U.S. and/or other countries.

Note
All products bearing a Victaulic trademark are manufactured by Victaulic or to Victaulic specifications. All products are to be installed only in accordance with the applicable Victaulic installation instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.