

STATE CERTIFICATION				SPRINKLER LEGEND			
	WASHINGTON STATE CERTIFICATE OF COMPETENCY FOR FIRE SPRINKLER SYSTEMS			SPRINKLER ORIFICE SIZES AND TYPE		UPRIGHT	PALENT SIZE
Matthew Gowen 9619-0311-C Level 3 Patriot Fire Protection, Inc. PATRIOTPOWER				$\frac{1}{2}$	$\frac{5}{8}$	$\frac{3}{4}$	$\frac{1}{2}$
 4-21-25				$\frac{1}{2}$	$\frac{5}{8}$	$\frac{3}{4}$	1" SPRAY
				$\frac{3}{4}$	$\frac{1}{2}$	$\frac{3}{4}$	1" SPRAY
				$\frac{1}{2}$	$\frac{3}{4}$	$\frac{1}{2}$	1" SIDEWALL
				1"	$\frac{1}{2}$	$\frac{3}{4}$	1" DRY TYPE
	2 - WAY EARTHQUAKE BRACE			TEMP RATING		SPRINKLER UP AND DOWN	SPRINKLER UP AND DOWN
	4 - WAY EARTHQUAKE BRACE			0	165°	212°	286°
	STRUCTURE TO CENTER LINE OF PIPE IN INCHES			1"	286°	350°	500°
FITTING LEGEND							
P	PLAIN END FIT FITTING				SN GROOVED SHAPED NIPPLE		
TSN	TAPERED SHAPED NIPPLE						
APPROVAL REQUIRED CITY OF PUYALLUP							

QUALITY CONTROL BY	DATE
APPROVED FOR FABRICATION BY	DATE

1. ALL MATERIAL AND EQUIPMENT TO BE NEW AND UL LISTED OR FM APPROVED.
2. PIPING DIMENSIONS ARE CENTER TO CENTER EXCEPT RISERS AND DIMENSIONS SHOWN THUS(1)-(6) WHICH ARE END TO END.
3. EARTHQUAKE BRACING SHALL BE PROVIDED IN ACCORDANCE WITH NFPA PAMPHLET NO. 13, 2019 EDITION
4. PIPE HANGERS AND METHOD OF HANGING TO BE IN ACCORDANCE WITH NFPA PAMPHLET NO. 13, 2019 EDITION
5. PIPING SHALL BE IN ACCORDANCE WITH NFPA PAMPHLET NO. 13, 2019 EDITION
6. JOINING OF PIPE AND FITTINGS, THREADED & WELDED, SHALL BE IN ACCORDANCE WITH NFPA PAMPHLET NO. 13, 2019 EDITION
7. OWNER TO PROVIDE ADEQUATE HEAD IN AREAS PROTECTED BY A WET PIPE SPRINKLER SYSTEM TO PREVENT WATER IN PIPES FROM FREEZING.
8. ALL WIRING OF ELECTRICAL DEVICES (IF REQUIRED) TO BE PROVIDED BY _____ OTHERS
9. PAINTING OF PIPE & EQUIPMENT (IF REQUIRED) TO BE PROVIDED BY _____ OTHERS
10. FURNISH OF PIPE & EQUIPMENT (IF REQUIRED) TO BE PROVIDED BY _____ OTHERS

1. DESIGN PER NFPA 13 (2019 EDITION).

1. ALL THREADED PIPE TO BE SCH. 40 BLK.

CONTRACT WITH:
RUSH COMMERCIAL CONSTRUCTION
6622 WOLLOCHET DR.
GIG HARBOR, WA 98335

PATRIOT
FIRE PROTECTION, INC.


2707 70TH AVENUE EAST
TACOMA, WA 98424

TEL: (253) 926-2290
FAX: (253) 922-6150


PATRIFP099CF
WWW.PATRIOTFIRE.COM
travis.mackey@patriotfire.com

[illegible]


SCALE: $\frac{1}{8}" = 1'-0"$

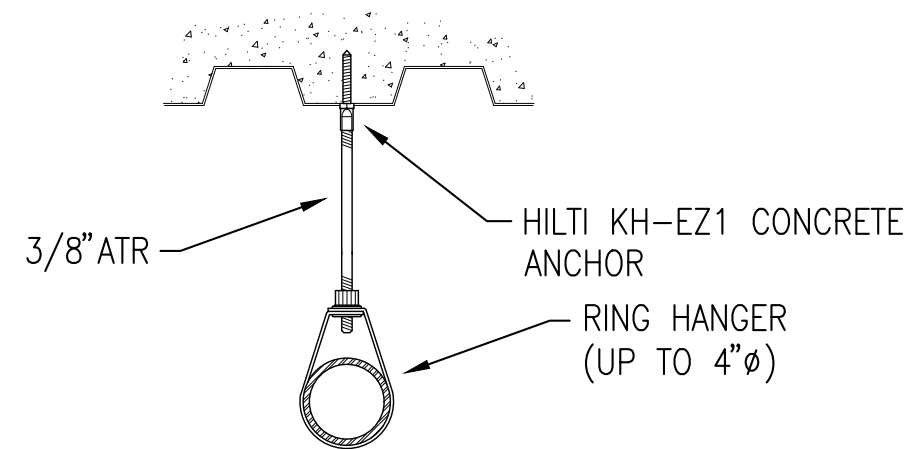

SCALE: NONE

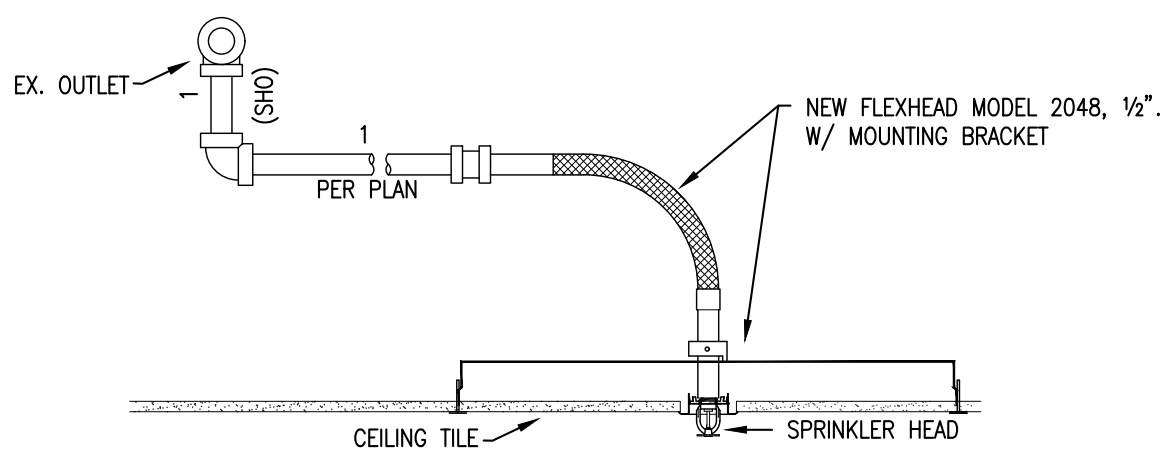

SCALE: NONE

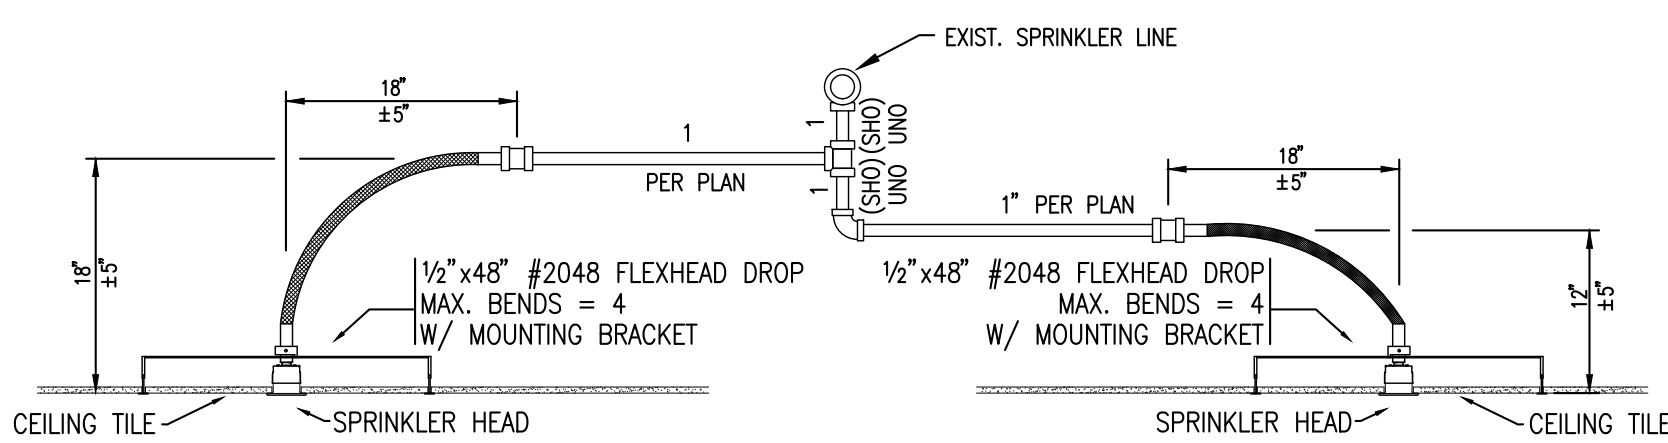

SCALE: NONE

