

Simple Heating System Size: Washington State

This heating system sizing calculator is based on the Prescriptive Requirements of the 2018 Washington State Energy Code (WSEC) and ACCA Manuals J and S. This tool will calculate heating loads only. ACCA procedures for sizing cooling systems should be used to determine cooling loads.

Please complete the green drop-downs and boxes that are applicable to your project. As you make selections in the drop-downs for each section, some values will be calculated for you. If you do not see the selection you need in the drop-down options, please contact the WSU Energy Program at energycode@energy.wsu.edu or (360) 956-2042 for assistance.

Project Information

1 Bed Int Unit - 3 Story Stack w/ Basement
Bradley Heights Apartments
Puyallup, WA

Contact Information

Milbrandt Architects
25 Central Way Suite 210
Kirkland, WA 98033 425.454.7130

Heating System Type:

☐ All Other Systems

☒ Heat Pump

To see detailed instructions for each section, place your cursor on the word "Instructions"

Design Temperature

[Instructions](#)

Puyallup

Design Temperature Difference (ΔT)

51

$\Delta T = \text{Indoor (70 degrees)} - \text{Outdoor Design Temp}$

Area of Building

Conditioned Floor Area

[Instructions](#)

Conditioned Floor Area (sq ft)

2,686

Average Ceiling Height

[Instructions](#)

Average Ceiling Height (ft)

9.1

Conditioned Volume

24,443

Glazing and Doors

[Instructions](#)

U-0.22

U-Factor	X	Area	=	UA
0.220		436		95.92

U-Factor	X	Area	=	UA
0.50		0		---

Skylights

[Instructions](#)

Insulation

Attic

[Instructions](#)

R-49

U-Factor	X	Area	=	UA
0.026		825		21.45

Single Rafter or Joist Vaulted Ceilings

[Instructions](#)

No Vaulted Ceilings in this project.

U-Factor	X	Area	=	UA
---		0		---

Above Grade Walls (see Figure 1)

[Instructions](#)

R-21 Intermediate

U-Factor	X	Area	=	UA
0.056		1,065		59.65

Floors

[Instructions](#)

No Floors above unconditioned spaces.

U-Factor	X	Area	=	UA
---				---

Below Grade Walls (see Figure 1)

[Instructions](#)

R-21 Interior

U-Factor	X	Area	=	UA
0.042		237		9.94

Slab Below Grade (see Figure 1)

[Instructions](#)

No Slab Below Grade in this project.

F-Factor	X	Length	=	UA
0.303		0		---

Slab on Grade (see Figure 1)

[Instructions](#)

R-10 Perimeter

F-Factor	X	Length	=	UA
0.540		712		384.48

Location of Ducts


[Instructions](#)

Unconditioned Space

Duct Leakage Coefficient

1.10

Figure 1.

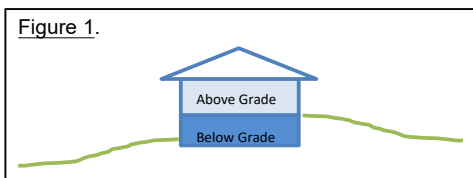

Sum of UA	571.43
Envelope Heat Load	29,143 Btu / Hour
Sum of UA x ΔT	
Air Leakage Heat Load	13,463 Btu / Hour
Volume x 0.6 x ΔT x 0.018	
Building Design Heat Load	42,606 Btu / Hour
Air leakage + envelope heat loss	
Building and Duct Heat Load	46,867 Btu / Hour
Ducts in unconditioned space: sum of building heat loss x 1.10	
Ducts in conditioned space: sum of building heat loss x 1	
Maximum Heat Equipment Output	58,583 Btu / Hour
Building and duct heat loss x 1.40 for forced air furnace	
Building and duct heat loss x 1.25 for heat pump	

FULL SIZED LEDGIBLE COLOR REPORT IS
REQUIRED TO BE PROVIDED BY THE
PERMITTEE ON SITE FOR ALL INSPECTIONS