



NORTHWEST FIRE SYSTEMS

22645 83rd Ave. S., Bldg D * Kent, WA 98032

Ph: 206.772.7502 * Fax: 206.772.7504

www.nwfiresystems.com LIC # NORTHFS928CR

City of Puyallup Development & Permitting Services ISSUED PERMIT			
Building	Planning		
Engineering	Public Works		
Fire	Traffic		

EQUIPMENT SUBMITTAL

Barnes & Noble
Puyallup, WA

NWFS JOB NO. 05532C

TABLE OF CONTENTS

Section 1 - Pipe & Fittings

- Wheatland Sch.10, Sch.40, MegaFlow Pipe
- Anvil Ductile Iron Threaded Fittings (Import)
- Victaulic Mechanical Tee Style 922
- Victaulic Grooved Rigid Couplings Style 009N
- Victaulic Grooved Firelock Fittings

Section 2 - Hangers & Sway Bracing

- Anvil All Thread Rod
- Anvil C-Type Clamp
- Anvil Retaining Clip
- Anvil Adjustable Swivel Ring Hanger
- Tolco Fig.825 Bar Joist Attachment
- Tolco Fig. 980 Universal Sway Brace Attachment
- Tolco Fig.1001 Lateral Brace Attachment

Section 3 - Fire Sprinklers

- Tyco RFII - Standard Response Concealed Pendent, 5.6 K
- Tyco TY-B - Standard Response Upright / Pendent, 5.6 K
- Tyco TY-FRB - Quick Response Pendent, 5.6 K

Section 4 - Miscellaneous

- Victaulic VicFlex Braided Flexible Hose

SECTION 1

PIPE AND FITTINGS

Fire Sprinkler Pipe

Schedule 10

Submittal Data Sheet



FM Approved and Fully Listed Sprinkler Pipe

Wheatland Tube's Schedule 10 steel fire sprinkler pipe is FM Approved and UL® and C-UL Listed.

Wheatland Tube is the only manufacturer with FM Approval on 10 NPS Schedule 10 steel fire sprinkler pipe.

Approvals and Specifications

Schedule 10 meets or exceeds the following standards:

- ASTM A135, Type E, Grade A (Schedule 10, 1-10 NPS)
- NFPA® 13 and NFPA 14

Manufacturing Protocols

Schedule 10 is subjected to the toughest possible testing protocols to ensure the highest quality and long-lasting performance.

Finishes and Coatings

Schedule 10 can be ordered in black or hot-dip galvanized to meet FM/UL requirements for dry systems that meet the zinc coating specifications of ASTM A53 or A795.

Schedule 10 receives a proprietary mill coating to ensure a clean, corrosion-resistant surface that outperforms and outlasts standard lacquer coatings. This coating allows the pipe to be easily painted without special preparation.

Every black steel Schedule 10 pipe also receives our MIC SHIELD™ antimicrobial coating to limit corrosion from microbes on the interior of the pipe.

Product Marking

Each length of Wheatland fire sprinkler pipe is continuously stenciled to show the manufacturer, type of pipe, grade, size and length. Bar coding is acceptable as a supplementary identification method.

SUBMITTAL INFORMATION

PROJECT:

CONTRACTOR:

DATE:

ENGINEER:

SPECIFICATION REFERENCE:

SYSTEM TYPE:

LOCATIONS:

COMMENTS:

☐ BLACK

☐ HOT-DIP GALVANIZED



1 Council Avenue, P.O. Box 608
Wheatland, PA 16161
P 800.257.8182
F 724.346.7260

info@wheatland.com
wheatland.com
Follow us on Twitter:
@WheatlandTube



Wheatland Tube
A DIVISION OF ZEKELMAN INDUSTRIES

Fire Sprinkler Pipe

Schedule 10

Submittal Data Sheet



SCHEDULE 10 WEIGHTS AND DIMENSIONS

NPS	NOMINAL OD		NOMINAL ID		NOMINAL WALL		WT./FT.	WT./FT. H ₂ O FILLED	PCS./LIFT	WT./LIFT 21'	WT./LIFT 24'	WT./LIFT 25'	UL
	in.	mm	in.	mm	in.	mm	lbs.	lbs.		lbs.	lbs.	lbs.	CRR*
1	1.315	33.4	1.097	27.9	0.109	2.77	1.405	1.814	70	2065	2360	2459	11.4
1¼	1.660	42.2	1.442	36.6	0.109	2.77	1.807	2.514	61	2315	2645	2756	7.3
1½	1.900	48.3	1.682	42.7	0.109	2.77	2.087	3.049	61	2673	3055	3183	5.8
2	2.375	60.3	2.157	54.8	0.109	2.77	2.640	4.222	37	2051	2344	2442	4.7
2½	2.875	73.0	2.635	66.9	0.120	3.05	3.354	5.895	30	2226	2544	2651	3.5
3	3.500	88.9	3.260	82.8	0.120	3.05	4.336	7.949	19	1730	1977	2060	2.6
4	4.500	114.3	4.260	108.2	0.120	3.05	5.619	11.789	19	2242	2562	2669	1.6
5	5.563	141.3	5.295	134.5	0.134	3.40	7.780	17.309	13	2124	2427	2529	1.5
6	6.625	168.3	6.357	161.5	0.134	3.40	9.298	23.038	10	1953	2232	2325	1.0
8	8.625	219.1	8.249	209.5	0.188	4.78	16.960	40.086	7	2493	2849	2968	1.7
10**	10.750	273.0	10.374	263.5	0.188	4.78	21.230	57.803	2	892	1019	1062	—

* Calculated using Standard UL CRR formula, UL Fire Protection Directory, Category VIZY. The CRR is a ratio value used to measure the ability of a pipe to withstand corrosion. Threaded Schedule 40 steel pipe is used as the benchmark (value of 1.0).

** 10 NPS Schedule 10 is FM Approved but not UL Listed.



1 Council Avenue, P.O. Box 608
Wheatland, PA 16161
P 800.257.8182
F 724.346.7260

info@wheatland.com
wheatland.com
Follow us on Twitter:
@WheatlandTube



Wheatland Tube
A DIVISION OF ZEKELMAN INDUSTRIES

WFS-072921

Fire Sprinkler Pipe

Schedule 40

Submittal Data Sheet



FM Approved and Fully Listed Sprinkler Pipe

Wheatland Tube's Schedule 40 steel fire sprinkler pipe is FM Approved and UL® and C-UL Listed.

Approvals and Specifications

Schedule 40 meets or exceeds the following standards:

- ASTM A795, Type E, Grade A (Schedule 40, 1-2 NPS)
- ASTM A53, Type E, Grade B (Schedule 40, 2-8 NPS)
- ASTM A53, Type F, Grade A (Schedule 40, 1-4 NPS)
- NFPA® 13 and NFPA 14

Manufacturing Protocols

Schedule 40 is subjected to the toughest possible testing protocols to ensure the highest quality and long-lasting performance.

Finishes and Coatings

Schedule 40 can be ordered in black or hot-dip galvanized to meet FM/UL requirements for dry systems that meet the zinc coating specifications of ASTM A53 or A795.

Schedule 40 receives a proprietary mill coating to ensure a clean, corrosion-resistant surface that outperforms and outlasts standard lacquer coatings. This coating allows the pipe to be easily painted without special preparation.

Every black steel Schedule 40 pipe also receives our MIC SHIELD™ antimicrobial coating to limit corrosion from microbes on the interior of the pipe.

Product Marking

Each length of Wheatland fire sprinkler pipe is continuously stenciled to show the manufacturer, type of pipe, grade, size and length. Bar coding is acceptable as a supplementary identification method.

SUBMITTAL INFORMATION

PROJECT:

CONTRACTOR:

DATE:

ENGINEER:

SPECIFICATION REFERENCE:

SYSTEM TYPE:

LOCATIONS:

COMMENTS:

☐ BLACK

☐ HOT-DIP GALVANIZED



1 Council Avenue, P.O. Box 608
Wheatland, PA 16161
P 800.257.8182
F 724.346.7260

info@wheatland.com
wheatland.com
Follow us on Twitter:
@WheatlandTube



Wheatland Tube
A DIVISION OF ZEKELMAN INDUSTRIES

Fire Sprinkler Pipe

Schedule 40

Submittal Data Sheet



SCHEDULE 40 WEIGHTS AND DIMENSIONS

NPS	NOMINAL OD		NOMINAL ID		NOMINAL WALL		WT./FT.	WT./FT. H ₂ O FILLED	PCS./LIFT	WT./LIFT 21'	WT./LIFT 24'	WT./LIFT 25'	UL
	in.	mm	in.	mm	in.	mm	lbs.	lbs.		lbs.	lbs.	lbs.	CRR*
1	1.315	33.4	1.049	26.6	0.133	3.38	1.68	2.055	70	2470	2822	2940	1.000
1¼	1.660	42.2	1.380	35.1	0.140	3.56	2.27	2.922	51	2431	2778	2894	1.000
1½	1.900	48.3	1.610	40.9	0.145	3.68	2.72	3.602	44	2513	2872	2992	1.000
2	2.375	60.3	2.067	52.5	0.154	3.91	3.66	5.109	24	1845	2108	2196	1.000
2½	2.875	73.0	2.469	62.7	0.203	5.16	5.80	7.871	20	2436	2784	2900	1.000
3	3.500	88.9	3.068	77.9	0.216	5.49	7.58	10.783	13	2069	2365	2464	1.000
3½	4.000	101.6	3.548	90.1	0.226	5.74	9.12	13.400	10	1915	2189	2280	1.000
4	4.500	114.3	4.026	102.3	0.237	6.02	10.80	16.311	10	2268	2592	2700	1.000
5	5.563	141.3	5.047	128.2	0.258	6.55	14.63	23.262	7	2151	2458	2560	1.000
6	6.625	168.3	6.065	154.1	0.280	7.11	18.99	31.498	5	1994	2279	2374	1.000
8**	8.625	219.1	7.981	202.7	0.322	8.18	28.58	50.240	5	3001	3430	3573	1.000

* Calculated using Standard UL CRR formula, UL Fire Protection Directory, Category VI-ZY. The CRR is a ratio value used to measure the ability of a pipe to withstand corrosion. Threaded Schedule 40 steel pipe is used as the benchmark (value of 1.0).

** 8 NPS Schedule 40 is FM Approved but not UL Listed.



1 Council Avenue, P.O. Box 608
Wheatland, PA 16161
P 800.257.8182
F 724.346.7260

info@wheatland.com
wheatland.com
Follow us on Twitter:
@WheatlandTube




Wheatland Tube
A DIVISION OF ZEKELMAN INDUSTRIES

WFS-072921

Fire Sprinkler Pipe

Mega-Flow and Mega-Thread Submittal Data Sheet

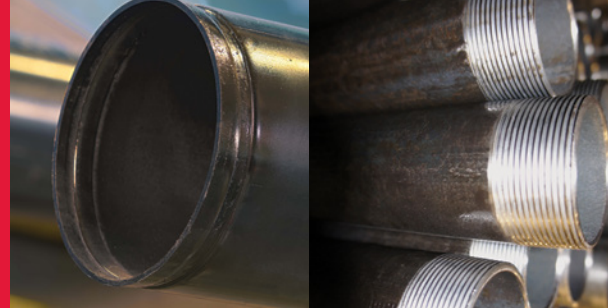

FM Approved and Fully Listed Sprinkler Pipe

Wheatland Tube's Mega-Flow steel fire sprinkler pipe is FM Approved for roll-grooved, plain-end and welded joints for wet systems; and UL® and C-UL Listed and FM Approved for use with roll-grooved, swage groove, plain-end couplings and welded joints for wet, dry preaction and deluge systems. Mega-Thread is FM Approved for use in wet systems and is UL and C-UL Listed and FM Approved for wet, dry and preaction sprinkler systems.

Approvals and Specifications

Both products meet or exceed these standards:

- ASTM A795, Type E, Grade A
- NFPA® 13 and NFPA 14
- Mega-Thread is approved for standard hanger spacing

Manufacturing Protocols

Mega-Flow and Mega-Thread are subjected to the toughest possible testing protocols to ensure the highest quality and long-lasting performance.

Finishes and Coatings

Mega-Flow, like all Wheatland black steel fire sprinkler pipe, receives a proprietary mill coating to ensure a clean, corrosion-resistant surface that outperforms and outlasts standard lacquer coatings. This coating allows the pipe to be easily painted without special preparation. Mega-Thread is hot-dip galvanized to meet FM requirements for dry systems.

Product Marking

Each length of Wheatland fire sprinkler pipe is continuously stenciled to show the manufacturer, type of pipe, grade, size and length. Barcoding is acceptable as a supplementary identification method.

MEGA-FLOW SPECIFICATIONS

NPS	NOM OD	NOM ID			UL CRR*		MEGA-FLOW	
		Mega-Flow	Schedule 10	Schedule 40	Mega-Flow	Schedule 40	Nominal wt./ft.	Pcs./Lift
1¼	1.660	1.530	1.442	1.380	1.80	1.00	1.108	61
1½	1.900	1.740	1.682	1.610	2.64	1.00	1.556	61
2	2.375	2.215	2.157	2.067	2.14	1.00	1.961	37
2½	2.875	2.707	2.635	2.469	1.43	1.00	2.504	30
3	3.500	3.316	3.260	3.068	1.34	1.00	3.349	19
4	4.500	4.316	4.260	4.026	1.00	1.00	4.331	19
6	6.625	6.395	6.357	6.065	0.75	1.00	8.000	10

* Calculated using Standard UL CRR formula, UL Fire Protection Directory, Category VIZY. The CRR is a ratio value used to measure the ability of a pipe to withstand corrosion. Threaded Schedule 40 steel pipe is used as the benchmark (value of 1.0).

MEGA-THREAD SPECIFICATIONS

NPS	NOM OD	NOM ID			UL CRR*		MEGA-THREAD	
		Mega-Thread	Schedule 40	Mega-Thread	Schedule 40	L.W.T. Pipe	Nominal wt./ft.	Pcs./Lift
1	1.315	1.079	1.049	1.00	1.00	0.61	1.462	70
1¼	1.660	1.416	1.380	1.00	1.00	0.39	1.989	51
1½	1.900	1.650	1.610	1.00	1.00	0.31	2.370	44
2	2.375	2.117	2.067	1.00	1.00	0.25	3.094	30

* Calculated using Standard UL CRR formula, UL Fire Protection Directory, Category VIZY. The CRR is a ratio value used to measure the ability of a pipe to withstand corrosion. Threaded Schedule 40 steel pipe is used as the benchmark (value of 1.0).



SUBMITTAL INFORMATION

PROJECT:

CONTRACTOR:

DATE:

ENGINEER:

SPECIFICATION REFERENCE:

SYSTEM TYPE:

LOCATIONS:

COMMENTS:

☐ MEGA-FLOW — BLACK

☐ MEGA-THREAD — HOT-DIP GALVANIZED

WFS-052920



1 Council Avenue, P.O. Box 608
Wheatland, PA 16161
P 800.257.8182
F 724.346.7260

info@wheatland.com
wheatland.com
Follow us on Twitter:
@WheatlandTube



Wheatland Tube
A DIVISION OF ZEKELMAN INDUSTRIES

Fire Sprinkler Pipe

Schedule 10

Submittal Data Sheet



FM Approved and Fully Listed Sprinkler Pipe

Wheatland Tube's Schedule 10 steel fire sprinkler pipe is FM Approved and UL® and C-UL Listed.

Wheatland Tube is the only manufacturer with FM Approval on 10 NPS Schedule 10 steel fire sprinkler pipe.

Approvals and Specifications

Schedule 10 meets or exceeds the following standards:

- ASTM A135, Type E, Grade A (Schedule 10, 1-10 NPS)
- NFPA® 13 and NFPA 14

Manufacturing Protocols

Schedule 10 is subjected to the toughest possible testing protocols to ensure the highest quality and long-lasting performance.

Finishes and Coatings

Schedule 10 can be ordered in black or hot-dip galvanized to meet FM/UL requirements for dry systems that meet the zinc coating specifications of ASTM A53 or A795.

Schedule 10 receives a proprietary mill coating to ensure a clean, corrosion-resistant surface that outperforms and outlasts standard lacquer coatings. This coating allows the pipe to be easily painted without special preparation.

Every black steel Schedule 10 pipe also receives our MIC SHIELD™ antimicrobial coating to limit corrosion from microbes on the interior of the pipe.

Product Marking

Each length of Wheatland fire sprinkler pipe is continuously stenciled to show the manufacturer, type of pipe, grade, size and length. Bar coding is acceptable as a supplementary identification method.

SUBMITTAL INFORMATION

PROJECT:

CONTRACTOR:

DATE:

ENGINEER:

SPECIFICATION REFERENCE:

SYSTEM TYPE:

LOCATIONS:

COMMENTS:

☐ BLACK

☐ HOT-DIP GALVANIZED



1 Council Avenue, P.O. Box 608
Wheatland, PA 16161
P 800.257.8182
F 724.346.7260

info@wheatland.com
wheatland.com
Follow us on Twitter:
@WheatlandTube



Wheatland Tube
A DIVISION OF ZEKELMAN INDUSTRIES

Fire Sprinkler Pipe

Schedule 10

Submittal Data Sheet



SCHEDULE 10 WEIGHTS AND DIMENSIONS

NPS	NOMINAL OD		NOMINAL ID		NOMINAL WALL		WT./FT.	WT./FT. H ₂ O FILLED	PCS./LIFT	WT./LIFT 21'	WT./LIFT 24'	WT./LIFT 25'	UL
	in.	mm	in.	mm	in.	mm	lbs.	lbs.		lbs.	lbs.	lbs.	CRR*
1	1.315	33.4	1.097	27.9	0.109	2.77	1.405	1.814	70	2065	2360	2459	11.4
1¼	1.660	42.2	1.442	36.6	0.109	2.77	1.807	2.514	61	2315	2645	2756	7.3
1½	1.900	48.3	1.682	42.7	0.109	2.77	2.087	3.049	61	2673	3055	3183	5.8
2	2.375	60.3	2.157	54.8	0.109	2.77	2.640	4.222	37	2051	2344	2442	4.7
2½	2.875	73.0	2.635	66.9	0.120	3.05	3.354	5.895	30	2226	2544	2651	3.5
3	3.500	88.9	3.260	82.8	0.120	3.05	4.336	7.949	19	1730	1977	2060	2.6
4	4.500	114.3	4.260	108.2	0.120	3.05	5.619	11.789	19	2242	2562	2669	1.6
5	5.563	141.3	5.295	134.5	0.134	3.40	7.780	17.309	13	2124	2427	2529	1.5
6	6.625	168.3	6.357	161.5	0.134	3.40	9.298	23.038	10	1953	2232	2325	1.0
8	8.625	219.1	8.249	209.5	0.188	4.78	16.960	40.086	7	2493	2849	2968	1.7
10**	10.750	273.0	10.374	263.5	0.188	4.78	21.230	57.803	2	892	1019	1062	—

* Calculated using Standard UL CRR formula, UL Fire Protection Directory, Category VIZY. The CRR is a ratio value used to measure the ability of a pipe to withstand corrosion. Threaded Schedule 40 steel pipe is used as the benchmark (value of 1.0).

** 10 NPS Schedule 10 is FM Approved but not UL Listed.



1 Council Avenue, P.O. Box 608
Wheatland, PA 16161
P 800.257.8182
F 724.346.7260

info@wheatland.com
wheatland.com
Follow us on Twitter:
@WheatlandTube




Wheatland Tube
A DIVISION OF ZEKELMAN INDUSTRIES

WFS-072921

FIG. 3201

90° Elbow



For Listings/Approval Details and Limitations, visit our website at www.anvilintl.com or contact an Anvil® Sales Representative.

FIGURE 3201 - 90° ELBOW

Nominal Size	Maximum Working Pressure▲	Dimension A	Approx. Wt. Each
<i>In. (mm)</i>	<i>PSI (kPa)</i>	<i>In. (mm)</i>	<i>Lbs. (kg)</i>
1	500	1.50	0.62
20	3450	38.10	0.28
1¼	500	1.75	0.90
32	3450	44.45	0.41
1½	500	1.94	1.20
40	3450	49.276	0.54
2	500	2.25	1.85
50	3450	57.15	0.84

▲ – Working Pressure Ratings are for reference only and based on Sch. 40 pipe. For the latest UL/ULC, and FM pressure ratings versus pipe schedule, please visit anvilintl.com or contact your local Anvil Representative.

MATERIAL SPECIFICATIONS

Dimensions: ASME B16.3

Material: ASTM A536 Grade 65-45-12

Finish: Black

Threads: NPT per ASME B1.20.1

Agency Approvals: All ductile iron threaded fittings are UL/ULC Listed and FM Approved.

NOTICE: Ductile iron fittings have higher tensile strength than that of steel pipe. Therefore, over tightening can cause damage to pipe threads which may cause leakage. Ductile iron fittings should be tightened approximately three turns beyond hand tight, but no more than four turns.


PROJECT INFORMATION

APPROVAL STAMP

Project:	<input type="checkbox"/> Approved
Address:	<input type="checkbox"/> Approved as noted
Contractor:	<input type="checkbox"/> Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	

FIG. 3207R

Reducing Cross

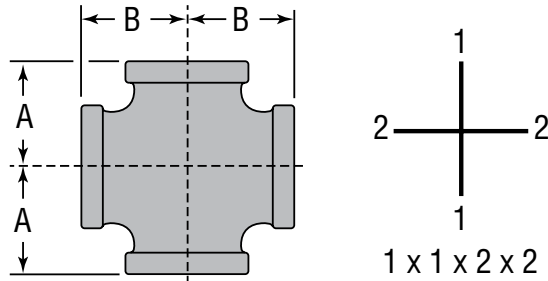

For Listings/Approval Details and Limitations, visit our website at www.anvilintl.com or contact an Anvil® Sales Representative.

FIGURE 3207R - REDUCING CROSS

Nominal Size	Max. Working Pressure▲	Dimensions		Approx. Wt. Each
1 x 1 x 2 x 2		A	B	
In. (mm)	PSI (kPa)	In. (mm)	In. (mm)	Lbs. (kg)
1¼ x 1¼ x 1 x 1 32 x 32 x 25 x 25	500 3450	1.58 40.13	1.67 42.41	1.27 0.58
1½ x 1½ x 1 x 1 40 x 40 x 25 x 25	500 3450	1.65 41.91	1.80 45.72	1.48 0.67
2 x 2 x 1 x 1 50 x 50 x 25 x 25	500 3450	1.73 43.94	2.02 51.30	2.10 0.95

▲ – Working Pressure Ratings are for reference only and based on Sch. 40 pipe. For the latest UL/ULC, and FM pressure ratings versus pipe schedule, please visit anvilintl.com or contact your local Anvil Representative.

MATERIAL SPECIFICATIONS

Dimensions: ASME B16.3

Material: ASTM A536 Grade 65-45-12

Finish: Black

Threads: NPT per ASME B1.20.1

Agency Approvals: All ductile iron threaded fittings are UL/ULC Listed and FM Approved.

NOTICE: Ductile iron fittings have higher tensile strength than that of steel pipe. Therefore, over tightening can cause damage to pipe threads which may cause leakage. Ductile iron fittings should be tightened approximately three turns beyond hand tight, but no more than four turns.

PROJECT INFORMATION

APPROVAL STAMP

Project:	<input type="checkbox"/> Approved
Address:	<input type="checkbox"/> Approved as noted
Contractor:	<input type="checkbox"/> Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	

FIG. 3283

Bushings

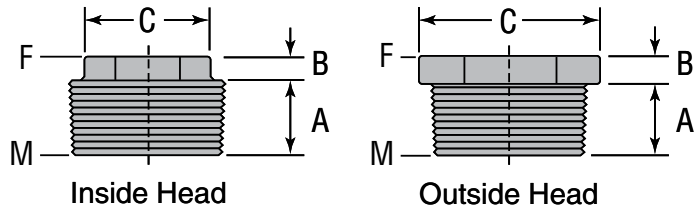


FIGURE 3283 - BUSHINGS

Nominal Size Male (M) x Female (F)	Max. Working Pressure▲	Dimensions			Style	Approx. Wt. Each
In. (mm)	PSI (kPa)	A In. (mm)	B In. (mm)	C In. (mm)		Lbs. (kg)
1 x 1/2 25 x 15	500 3450	0.75 19.05	0.25 6.35	1.42 36.06	Outside	0.22 0.10
1 1/4 x 1 32 x 25	500 3450	0.75 19.05	0.25 6.35	1.42 36.06	Outside	0.17 0.08
1 1/2 x 1 40 x 25	500 3450	0.80 20.32	0.28 7.11	1.76 44.70	Outside	0.28 0.13
1 3/4 x 1 1/4 40 x 32	500 3450	0.83 21.08	0.31 7.874	2.00 50.80	Outside	0.45 0.20
2 x 1 50 x 25	500 3450	0.83 21.08	0.31 7.874	2.00 50.80	Outside	0.30 0.14
2 x 1 1/4 50 x 32	500 3450	0.88 22.35	0.41 10.414	1.95 49.53	Inside	0.67 0.30
2 x 1 1/2 50 x 40	500 3450	0.88 22.35	0.34 8.636	2.48 62.99	Outside	0.73 0.33
					Outside	0.61 0.28

▲ – Working Pressure Ratings are for reference only and based on Sch. 40 pipe. For the latest UL/ULC, and FM pressure ratings versus pipe schedule, please visit anvilintl.com or contact your local Anvil Representative.

MATERIAL SPECIFICATIONS

Dimensions: ASME B16.14

Material: ASTM A536 Grade 65-45-12

Finish: Black

Threads: NPT per ASME B1.20.1

Agency Approvals: All ductile iron threaded fittings are UL/ULC Listed and FM Approved.

NOTICE: Ductile iron fittings have higher tensile strength than that of steel pipe. Therefore, over tightening can cause damage to pipe threads which may cause leakage. Ductile iron fittings should be tightened approximately three turns beyond hand tight, but no more than four turns.


PROJECT INFORMATION

APPROVAL STAMP

Project:	<input type="checkbox"/> Approved
Address:	<input type="checkbox"/> Approved as noted
Contractor:	<input type="checkbox"/> Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	

FIG. 3224

Cap



For Listings/Approval Details and Limitations, visit our website at www.anvilintl.com or contact an Anvil® Sales Representative.

FIGURE 3224 - CAP

Nominal Size	Maximum Working Pressure▲	Dimension A	Approx. Wt. Each
<i>In. (mm)</i>	<i>PSI (kPa)</i>	<i>In. (mm)</i>	<i>Lbs. (kg)</i>
1	500	1.16	0.32
25	3450	29.46	0.15
1¼	500	1.28	0.43
32	3450	32.51	0.20
1½	500	1.33	0.60
40	3450	33.78	0.27
2	500	1.45	0.91
50	3450	36.83	0.41

▲ – Working Pressure Ratings are for reference only and based on Sch. 40 pipe. For the latest UL/ULC, and FM pressure ratings versus pipe schedule, please visit anvilintl.com or contact your local Anvil Representative.

MATERIAL SPECIFICATIONS

Dimensions: ASME B16.3

Material: ASTM A536 Grade 65-45-12

Finish: Black

Threads: NPT per ASME B1.20.1

Agency Approvals: All ductile iron threaded fittings are UL/ULC Listed and FM Approved.

NOTICE: Ductile iron fittings have higher tensile strength than that of steel pipe. Therefore, over tightening can cause damage to pipe threads which may cause leakage. Ductile iron fittings should be tightened approximately three turns beyond hand tight, but no more than four turns.


PROJECT INFORMATION

APPROVAL STAMP

Project:	<input type="checkbox"/> Approved
Address:	<input type="checkbox"/> Approved as noted
Contractor:	<input type="checkbox"/> Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	

FIG. 3207

Cross

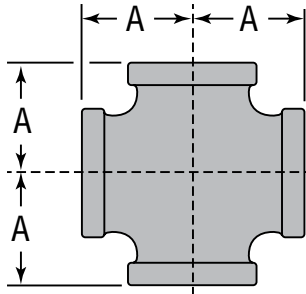

For Listings/Approval Details and Limitations, visit our website at www.anvilintl.com or contact an Anvil® Sales Representative.

FIGURE 3207 - CROSS

Nominal Size	Maximum Working Pressure▲	Dimension A	Approx. Wt. Each
<i>In. (mm)</i>	<i>PSI (kPa)</i>	<i>In. (mm)</i>	<i>Lbs. (kg)</i>
1	500	1.50	0.98
25	3450	38.10	0.44
1¼	500	1.75	1.50
32	3450	44.45	0.68
1½	500	1.94	1.90
40	3450	49.27	0.86
2	500	2.25	2.95
50	3450	57.15	1.34

▲ – Working Pressure Ratings are for reference only and based on Sch. 40 pipe. For the latest UL/ULC, and FM pressure ratings versus pipe schedule, please visit anvilintl.com or contact your local Anvil Representative.

MATERIAL SPECIFICATIONS

Dimensions: ASME B16.3

Material: ASTM A536 Grade 65-45-12

Finish: Black

Threads: NPT per ASME B1.20.1

Agency Approvals: All ductile iron threaded fittings are UL/ULC Listed and FM Approved.

NOTICE: Ductile iron fittings have higher tensile strength than that of steel pipe. Therefore, over tightening can cause damage to pipe threads which may cause leakage. Ductile iron fittings should be tightened approximately three turns beyond hand tight, but no more than four turns.


PROJECT INFORMATION

APPROVAL STAMP

Project:	<input type="checkbox"/> Approved
Address:	<input type="checkbox"/> Approved as noted
Contractor:	<input type="checkbox"/> Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	

FIG. 3201R

Reducing 90° Elbow

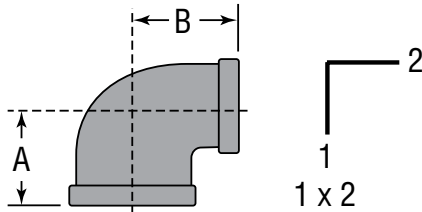

For Listings/Approval Details and Limitations, visit our website at www.anvilintl.com or contact an Anvil® Sales Representative.

FIGURE 3201R - REDUCING 90° ELBOW

Nominal Size	Max. Working Pressure [▲]	Dimensions		Approx. Wt. Each
1 x 2		A	B	
In. (mm)	PSI (kPa)	In. (mm)	In. (mm)	Lbs. (kg)
1 x ½ 25 x 15	500 3450	1.26 32.00	1.36 34.54	0.44 0.20
1 x ¾ 25 x 20	500 3450	1.37 34.79	1.45 36.83	0.52 0.24
1¼ x ½ 32 x 15	500 34550	1.34 34.03	1.53 38.86	0.64 0.29
1¼ x ¾ 32 x 20	500 3450	1.45 36.83	1.62 41.14	0.72 0.33
1¼ x 1 32 x 25	500 3450	1.58 40.13	1.67 42.41	0.75 0.34
1½ x 1 40 x 25	500 3450	1.65 41.91	1.80 45.72	0.92 0.42
1½ x 1¼ 40 x 32	500 3450	1.82 46.22	1.88 47.75	1.08 0.49
2 x ½ 50 x 15	500 3450	1.49 37.84	1.88 47.75	1.08 0.49
2 x ¾ 50 x 20	500 3450	1.60 40.64	1.97 50.03	1.24 0.56
2 x 1 50 x 25	500 3450	1.73 43.94	2.02 51.30	1.40 0.64
2 x 1¼ 50 x 32	500 3450	1.90 48.26	2.10 53.34	1.52 0.70
2 x 1½ 50 x 40	500 3450	2.02 51.30	2.16 54.86	1.65 0.75

▲ – Working Pressure Ratings are for reference only and based on Sch. 40 pipe. For the latest UL/ULC, and FM pressure ratings versus pipe schedule, please visit anvilintl.com or contact your local Anvil Representative.

MATERIAL SPECIFICATIONS

Dimensions: ASME B16.3

Material: ASTM A536 Grade 65-45-12

Finish: Black

Threads: NPT per ASME B1.20.1

Agency Approvals: All ductile iron threaded fittings are UL/ULC Listed and FM Approved.

NOTICE: Ductile iron fittings have higher tensile strength than that of steel pipe. Therefore, over tightening can cause damage to pipe threads which may cause leakage. Ductile iron fittings should be tightened approximately three turns beyond hand tight, but no more than four turns.


PROJECT INFORMATION

APPROVAL STAMP

Project:	<input type="checkbox"/> Approved
Address:	<input type="checkbox"/> Approved as noted
Contractor:	<input type="checkbox"/> Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	

FIG. 3221R

Reducing Coupling



For Listings/Approval Details and Limitations, visit our website at www.anvilintl.com or contact an Anvil® Sales Representative.

FIGURE 3221R - REDUCING COUPLING

Nominal Size	Maximum Working Pressure▲	Dimension A	Approx. Wt. Each
<i>In. (mm)</i>	<i>PSI (kPa)</i>	<i>In. (mm)</i>	<i>Lbs. (kg)</i>
1 x 1/2 25 x 15	500 3450	1.69 42.92	0.39 0.18
1 x 3/4 25 x 20	500 3450	1.69 42.92	0.53 0.24

▲ – Working Pressure Ratings are for reference only and based on Sch. 40 pipe. For the latest UL/ULC, and FM pressure ratings versus pipe schedule, please visit anvilintl.com or contact your local Anvil Representative.

MATERIAL SPECIFICATIONS

Dimensions: ASME B16.3

Material: ASTM A536 Grade 65-45-12

Finish: Black

Threads: NPT per ASME B1.20.1

Agency Approvals: All ductile iron threaded fittings are UL/ULC Listed and FM Approved.

NOTICE: Ductile iron fittings have higher tensile strength than that of steel pipe. Therefore, over tightening can cause damage to pipe threads which may cause leakage. Ductile iron fittings should be tightened approximately three turns beyond hand tight, but no more than four turns.


PROJECT INFORMATION

APPROVAL STAMP

Project:	<input type="checkbox"/> Approved
Address:	<input type="checkbox"/> Approved as noted
Contractor:	<input type="checkbox"/> Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	

FIG. 3205R

Reducing Tee

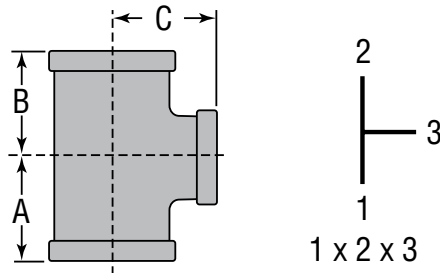

For Listings/Approval Details and Limitations, visit our website at www.anvilintl.com or contact an Anvil® Sales Representative.

FIGURE 3205R - REDUCING TEE

Nominal Size	Max. Working Pressure▲	Dimensions			Approx. Wt. Each
1 x 2 x 3		A	B	C	
In. (mm)	PSI (kPa)	In. (mm)	In. (mm)	In. (mm)	Lbs. (kg)
1 x 1/2 x 1 25 x 15 x 25	500 3450	1.50 38.10	1.36 34.54	1.50 38.10	0.64 0.29
1 x 3/4 x 1 25 x 20 x 25	500 3450	1.50 38.10	1.45 36.83	1.50 38.10	0.73 0.33
1 x 1 x 1/2 25 x 25 x 15	500 3450	1.26 32.00	1.26 32.00	1.36 34.54	0.71 0.32
1 x 1 x 3/4 25 x 25 x 20	500 3450	1.37 34.80	1.37 34.80	1.45 36.83	0.76 0.34
1 x 1 x 1 1/4* 25 x 25 x 32	500 3450	1.67 42.41	1.67 42.41	1.58 40.13	0.98 0.44
1 x 1 x 1 1/2* 25 x 25 x 40	500 3450	1.80 45.72	1.80 45.72	1.65 41.91	1.16 0.53
1 1/4 x 1 x 1/2* 32 x 25 x 15	500 3450	1.34 34.04	1.26 32.00	1.53 38.86	0.82 0.37
1 1/4 x 1 x 3/4 32 x 25 x 20	500 3450	1.45 36.83	1.37 34.80	1.62 41.15	0.90 0.41
1 1/4 x 1 x 1 32 x 25 x 25	500 3450	1.58 40.13	1.50 38.10	1.67 42.42	1.00 0.45
1 1/4 x 1 x 1 1/4 32 x 25 x 32	500 3450	1.75 44.45	1.67 42.42	1.75 44.45	1.08 0.49
1 1/4 x 1 x 1 1/2 32 x 25 x 40	500 3450	1.88 47.75	1.80 45.72	1.82 46.22	1.42 0.64
1 1/4 x 1 1/4 x 1/2 32 x 32 x 15	500 3450	1.34 34.04	1.34 34.04	1.53 38.86	0.86 0.39

▲ Working Pressure Ratings are for reference only and based on Sch. 40 pipe. For the latest UL/ULC, and FM pressure ratings versus pipe schedule, please visit anvilintl.com or contact your local Anvil Representative.

* Part supplied as "Bull Head Tee".

MATERIAL SPECIFICATIONS

Dimensions: ASME B16.3

Material: ASTM A536 Grade 65-45-12

Finish: Black

Threads: NPT per ASME B1.20.1

Agency Approvals: All ductile iron threaded fittings are UL/ULC Listed and FM Approved.

NOTICE: Ductile iron fittings have higher tensile strength than that of steel pipe. Therefore, over tightening can cause damage to pipe threads which may cause leakage. Ductile iron fittings should be tightened approximately three turns beyond hand tight, but no more than four turns.

FIGURE 3205R - REDUCING TEE

Nominal Size	Max. Working Pressure▲	Dimensions			Approx. Wt. Each
1 x 2 x 3		A	B	C	
In. (mm)	PSI (kPa)	In. (mm)	In. (mm)	In. (mm)	Lbs. (kg)
1 1/4 x 1 1/4 x 3/4 32 x 32 x 20	500 3450	1.45 36.83	1.45 36.83	1.62 41.15	0.92 0.42
1 1/4 x 1 1/4 x 1 32 x 32 x 25	500 3450	1.58 40.13	1.58 40.13	1.67 42.42	0.95 0.43
1 1/4 x 1 1/4 x 1 1/2* 32 x 32 x 40	500 3450	1.88 47.75	1.88 47.75	1.82 46.22	1.45 0.66

PROJECT INFORMATION

APPROVAL STAMP

Project:	<input type="checkbox"/> Approved
Address:	<input type="checkbox"/> Approved as noted
Contractor:	<input type="checkbox"/> Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	

FIG. 3205R

Reducing Tee

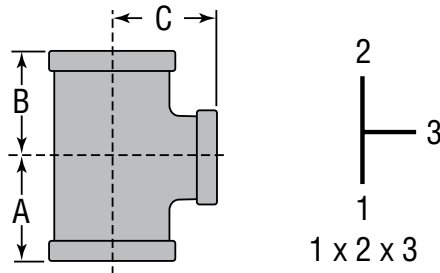


FIGURE 3205R - REDUCING TEE

Nominal Size	Max. Working Pressure▲	Dimensions			Approx. Wt. Each
1 x 2 x 3		A	B	C	
In. (mm)	PSI (kPa)	In. (mm)	In. (mm)	In. (mm)	Lbs. (kg)
1¼ x 1¼ x 2*	500 3450	2.10 53.34	2.10 53.34	1.90 48.26	1.75 0.79
1½ x 1 x ½	500 3450	1.41 35.81	1.34 34.04	1.66 42.16	0.95 0.43
1½ x 1 x ¾	500 3450	1.52 38.61	1.37 34.80	1.75 44.45	1.14 0.52
1½ x 1 x 1	500 3450	1.65 41.91	1.50 38.10	1.80 45.72	1.17 0.53
1½ x 1 x 1¼	500 3450	1.82 46.23	1.67 42.42	1.88 47.75	1.34 0.61
1½ x 1 x 1½	500 3450	1.94 49.28	1.80 45.72	1.94 49.28	1.45 0.66
1½ x 1¼ x ½	500 3450	1.41 35.81	1.34 34.04	1.66 42.16	1.05 0.48
1½ x 1¼ x ¾	500 3450	1.52 38.61	1.45 36.83	1.75 44.45	1.15 0.5
1½ x 1¼ x 1	500 3450	1.65 41.91	1.58 40.13	1.80 45.72	1.25 0.57
1½ x 1¼ x 2*	500 3450	2.16 54.86	2.10 53.34	2.02 51.30	1.90 0.86
1½ x 1½ x ½	500 3450	1.41 35.81	1.41 35.81	1.16 29.46	1.15 0.52
1½ x 1½ x ¾	500 3450	1.52 38.61	1.52 38.61	1.75 44.45	1.24 0.56
1½ x 1½ x 1	500 3450	1.65 41.91	1.65 41.91	1.80 45.72	1.30 0.59
1½ x 1½ x 1¼	500 3450	1.82 46.23	1.82 46.23	1.88 47.75	1.48 0.67

FIGURE 3205R - REDUCING TEE


Nominal Size	Max. Working Pressure▲	Dimensions			Approx. Wt. Each
1 x 2 x 3		A	B	C	
In. (mm)	PSI (kPa)	In. (mm)	In. (mm)	In. (mm)	Lbs. (kg)
1½ x 1½ x 2*	500 3450	2.16 54.86	2.16 54.86	2.02 51.30	1.98 0.90
2 x 1 x 2	500 3450	2.25 57.15	2.02 51.31	2.25 57.15	2.15 0.98
2 x 1¼ x 2	500 3450	2.25 57.15	2.10 53.34	2.25 57.15	2.30 1.04
2 x 1½ x ½	500 3450	1.49 37.85	1.41 35.81	1.88 47.75	1.50 0.68
2 x 1½ x ¾	500 3450	1.60 40.64	1.52 38.61	1.97 50.04	1.62 0.73
2 x 1½ x 1	500 3450	1.73 43.94	1.65 41.91	2.02 51.31	1.64 0.74
2 x 1½ x 1¼	500 3450	1.90 48.26	1.82 46.23	2.10 53.34	1.80 0.82
2 x 1½ x 1½	500 3450	2.02 51.31	1.94 49.28	2.16 54.86	2.00 0.91
2 x 1½ x 2	500 3450	2.25 57.15	2.16 54.86	2.25 57.15	2.35 1.07
2 x 2 x ½	500 3450	1.49 37.85	1.49 37.85	1.88 47.75	1.60 0.73
2 x 2 x ¾	500 3450	1.60 40.64	1.60 40.64	1.97 50.04	1.68 0.76
2 x 2 x 1	500 3450	1.73 43.94	1.73 43.94	2.02 51.31	1.85 0.84
2 x 2 x 1¼	500 3450	1.90 48.26	1.90 48.26	2.10 53.34	2.04 0.93
2 x 2 x 1½	500 3450	2.02 51.31	2.02 51.31	2.16 54.86	2.18 0.99

▲ Working Pressure Ratings are for reference only and based on Sch. 40 pipe. For the latest UL/ULC, and FM pressure ratings versus pipe schedule, please visit anvilintl.com or contact your local Anvil Representative.

* Part supplied as "Bull Head Tee".

FIG. 3205

Straight Tee



For Listings/Approval Details and Limitations, visit our website at www.anvilintl.com or contact an Anvil® Sales Representative.

FIGURE 3205 - STRAIGHT TEE

Nominal Size	Maximum Working Pressure▲	Dimension A	Approx. Wt. Each
<i>In. (mm)</i>	<i>PSI (kPa)</i>	<i>In. (mm)</i>	<i>Lbs. (kg)</i>
1	500	1.50	0.85
25	3450	38.10	0.39
1¼	500	1.75	1.22
32	3450	44.45	0.55
1½	500	1.94	1.55
40	3450	49.27	0.70
2	500	2.25	2.45
50	3450	57.15	1.11

▲ – Working Pressure Ratings are for reference only and based on Sch. 40 pipe. For the latest UL/ULC, and FM pressure ratings versus pipe schedule, please visit anvilintl.com or contact your local Anvil Representative.

MATERIAL SPECIFICATIONS

Dimensions: ASME B16.3

Material: ASTM A536 Grade 65-45-12

Finish: Black

Threads: NPT per ASME B1.20.1

Agency Approvals: All ductile iron threaded fittings are UL/ULC Listed and FM Approved.

NOTICE: Ductile iron fittings have higher tensile strength than that of steel pipe. Therefore, over tightening can cause damage to pipe threads which may cause leakage. Ductile iron fittings should be tightened approximately three turns beyond hand tight, but no more than four turns.

PROJECT INFORMATION

APPROVAL STAMP

Project:	<input type="checkbox"/> Approved
Address:	<input type="checkbox"/> Approved as noted
Contractor:	<input type="checkbox"/> Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	

Victaulic® FireLock™ Outlet-T

Style 922



1.0 PRODUCT DESCRIPTION

Available Sizes

- 1 ¼ – 2 ½"/DN32 – DN65
- **Threaded Outlet Sizes:** ½"/DN15, ¾"/DN20, and 1"/DN25

NOTE

- IGS Grooved 1"/DN25 Outlets available for this product. See [publication 10.54](#).

Maximum Working Pressure

- 300 psi/2068 kPa/21 Bar

Application

- Provides a convenient method of incorporating outlets for directly connecting sprinklers, drop nipples, sprigs, gauges, drains and other outlet products

Pipe Material

- Carbon steel
- Contact Victaulic for use on additional pipe types and wall thicknesses

2.0 CERTIFICATION/LISTINGS



NOTES

- See Section 7.2 REFERENCE MATERIALS for additional certification information.

ALWAYS REFER TO ANY NOTIFICATIONS AT THE END OF THIS DOCUMENT REGARDING PRODUCT INSTALLATION, MAINTENANCE OR SUPPORT.

System No.		Location	
Submitted By		Date	

Spec Section		Paragraph	
Approved		Date	

3.0 SPECIFICATIONS - MATERIAL

Housing: Ductile iron conforming to ASTM A536, Grade 65-45-12. Ductile iron conforming to ASTM A395, Grade 65-45-15, is available upon special request.

Housing Coating: (specify choice)

Orange enamel (North America, Latin America, Asia Pacific).

Red enamel (Europe).

Optional: Contact Victaulic with your requirements for other coatings.

Gasket¹:

Grade "E" EPDM (Type A)

EPDM (Violet color code) Applicable for wet and dry (oil-free air) sprinkler services only. Listed/Approved for continuous use in wet and dry systems. Listed/Approved for dry systems at -40°F/-40°C and above. NOT COMPATIBLE FOR USE WITH HOT WATER SERVICES OR STEAM SERVICES.


¹ Services listed are General Service Guidelines only. It should be noted that there are services for which these gaskets are not compatible. Reference should always be made to the latest [Victaulic Seal Selection Guide](#) for specific gasket service guidelines and for a listing of services which are not compatible.

Bolts/Nuts:

Standard: Carbon steel oval neck track bolts meeting the mechanical property requirements of ASTM A449 (imperial) and ISO 898-1 Class 9.8 (metric). Carbon steel hex flange nuts meeting the mechanical property requirements of ASTM A563 Grade B (imperial – hex nuts) and ASTM A563M Class 9 (metric – hex nuts). Track bolts and hex flange nuts are zinc electroplated per ASTM B633 Fe/Zn 5, finish Type III (imperial) or Type II (metric).

4.0 DIMENSIONS

Style 922

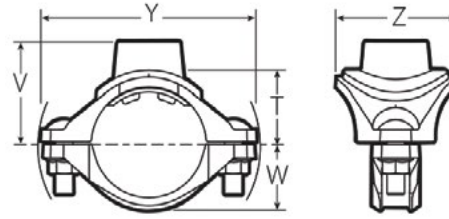

Style 922

Size				Bolt/Nut		Dimensions					Weight	
Nominal Run x Branch FPT ²		Actual Outside Diameter		Qty.	Size	T ³	V	W	Y	Z	Approximate (Each)	
inches DN		inches mm			inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	lb	kg
1 1/4 DN32	x	1/2 DN15	x	2	3/8 x 1 3/8	1.30 33	1.83 47	1.10 28	3.87 98	2.56 65	1	0.5
				2	3/8 x 1 3/8	1.28 33	1.83 47	1.10 28	3.87 98	2.56 65	1	0.5
				2	3/8 x 1 3/8	1.52 39	2.18 55	1.10 28	3.87 98	2.56 65	1	0.5
				2	3/8 x 1 3/8	1.28 33	1.83 47	1.10 28	3.87 98	2.56 65	1	0.5
1 1/2 40	x	1/2 DN15	x	2	3/8 x 1 3/8	1.42 36	1.95 50	1.22 31	4.08 104	2.56 65	1	0.5
				2	3/8 x 1 3/8	1.40 36	1.95 50	1.22 31	4.08 104	2.56 65	1	0.5
				2	3/8 x 1 3/8	1.64 42	2.30 58	1.22 31	4.08 104	2.56 65	1	0.6
				2	3/8 x 1 3/8	1.64 42	2.19 56	1.46 37	4.60 117	2.56 65	1	0.6
2 50	x	1/2 DN15	x	2	3/8 x 1 3/8	1.66 42	2.19 56	1.46 37	4.60 117	2.56 65	1	0.6
				2	3/8 x 1 3/8	1.64 42	2.19 56	1.46 37	4.60 117	2.56 65	1	0.6
				2	3/8 x 1 3/8	1.88 48	2.54 65	1.46 37	4.60 117	2.56 65	2	0.7
				2	3/8 x 1 3/8	1.91 49	2.44 62	1.71 43	5.40 137	2.56 65	2	0.7
2 1/2	x	1/2 DN15	x	2	3/8 x 1 3/8	1.89 48	2.44 62	1.71 43	5.40 137	2.56 65	2	0.7
				2	3/8 x 1 3/8	2.13 54	2.79 71	1.71 43	5.40 137	2.56 65	2	0.7
				2	3/8 x 1 3/8	2.13 54	2.79 71	1.71 43	5.40 137	2.56 65	2	0.7
				2	3/8 x 1 3/8	2.13 54	2.79 71	1.71 43	5.40 137	2.56 65	2	0.7
DN65	x	1/2 DN15	x	2	3/8 x 1 3/8	1.91 49	2.44 62	1.71 43	5.50 140	2.56 65	2	0.7
				2	3/8 x 1 3/8	1.89 48	2.44 62	1.71 43	5.50 140	2.56 65	2	0.7
				2	3/8 x 1 3/8	2.13 54	2.79 71	1.71 43	5.50 140	2.56 65	2	0.7
				2	3/8 x 1 3/8	2.13 54	2.79 71	1.71 43	5.50 140	2.56 65	2	0.8

² Victaulic female threaded products are designed to accommodate standard NPT or BSPT (optional) male pipe threads only. Refer to the specific literature for these types of special male-threaded products for guidance and possible limitations for use. Failure to verify suitability in advance may result in assembly problems or leakage.

³ Center of run to engaged pipe end for NPT threads (dimensions are approximate).

5.0 PERFORMANCE







Style 922

Run Size x Outlet Size inches DN	Equivalent Length of 1 inch Schedule 40 Steel Pipe (per UL 213, Section 16) (C=120) ⁴	
	Threaded feet meters	Grooved ⁵ feet meters
1 ¼ x 1 DN32 x DN25	8.5 2.6	12.5 3.8
1 ½ x 1 DN40 x DN25	8.5 2.6	12.5 3.8
2 x 1 DN50 x DN25	8.5 2.6	12.5 3.8
2 ½ x 1 DN65 x DN25	8.5 2.6	12.5 3.8

⁴ Hazen-Williams coefficient of friction is 120.

⁵ 1" FireLock™ Innovative Groove System (IGS) outlet

6.0 NOTIFICATIONS

WARNING					
					
<ul style="list-style-type: none"> Read and understand all instructions before attempting to install, remove, adjust, or maintain any Victaulic piping products. Depressurize and drain the piping system before attempting to install, remove, adjust, or maintain any Victaulic piping products. Wear safety glasses, hardhat, and foot protection. <p>Failure to follow these instructions could result in death or serious personal injury and property damage.</p>					

7.0 REFERENCE MATERIALS

	Dimensions	
	Minimum Hole Diameter/ Hole Saw Size inches mm	Maximum Hole Diameter/ Hole Saw Size inches mm
All Outlet Sizes	1 ⅝ 30	1 ¼ 32

7.1 REFERENCE MATERIALS

Size	Services Pressures per Regulatory Approvals and Listings ⁶					
Nominal inches DN	UL psi kPa	ULC psi kPa	FM psi kPa	VdS psi kPa	LPCB psi kPa	CNBOP psi kPa
1 ¼ x ½ DN32 X DN15	300 2068	300 2068	300 2068	232 1600	232 1600	232 1600
1 ¼ x ¾ DN32 X DN20	300 2068	300 2068	300 2068	232 1600	232 1600	232 1600
1 ¼ x 1 DN32 X DN25	300 2068	300 2068	300 2068	232 1600	232 1600	232 1600
1 ½ x ½ DN40 X DN15	300 2068	300 2068	300 2068	232 1600	232 1600	232 1600
1 ½ x ¾ DN40 X DN20	300 2068	300 2068	300 2068	232 1600	232 1600	232 1600
1 ½ x 1 DN40 X DN25	300 2068	300 2068	300 2068	232 1600	232 1600	232 1600
2 x ½ DN50 X DN15	300 2068	300 2068	300 2068	232 1600	232 1600	232 1600
2 x ¾ DN50 X 20	300 2068	300 2068	300 2068	232 1600	232 1600	232 1600
2 x 1 DN50 X DN25	300 2068	300 2068	300 2068	232 1600	232 1600	232 1600
2 ½ x ½	300 2068	300 2068	300 2068	232 1600	232 1600	232 1600
2 ½ x ¾	300 2068	300 2068	300 2068	232 1600	232 1600	232 1600
2 ½ x 1	300 2068	300 2068	300 2068	232 1600	232 1600	232 1600
DN65 X DN15	–	–	300 2068	232 1600	232 1600	232 1600
DN65 X DN20	–	–	300 2068	232 1600	232 1600	232 1600
DN65 X DN25	–	–	300 2068	232 1600	232 1600	232 1600

⁶ Pressures listed in this chart are based upon standard wall pipe. Approved and Listed pressures may vary by pipe schedule.

NOTE

- Consult regulatory agency websites for details and the most recent regulatory information.

7.2 REFERENCE MATERIALS

[05.01: Victaulic Seal Selection Guide](#)

[29.01: Victaulic Terms and Conditions of Sale](#)

[I-100: Installation Instructions](#)

[I-922: Installation Instructions FireLock™ Outlet-T](#)

User Responsibility for Product Selection and Suitability

Each user bears final responsibility for making a determination as to the suitability of Victaulic products for a particular end-use application, in accordance with industry standards and project specifications, and the applicable building codes and related regulations as well as Victaulic performance, maintenance, safety, and warning instructions. Nothing in this or any other document, nor any verbal recommendation, advice, or opinion from any Victaulic employee, shall be deemed to alter, vary, supersede, or waive any provision of Victaulic Company's standard conditions of sale, installation guide, or this disclaimer.

Intellectual Property Rights

No statement contained herein concerning a possible or suggested use of any material, product, service, or design is intended, or should be construed, to grant any license under any patent or other intellectual property right of Victaulic or any of its subsidiaries or affiliates covering such use or design, or as a recommendation for the use of such material, product, service, or design in the infringement of any patent or other intellectual property right. The terms "Patented" or "Patent Pending" refer to design or utility patents or patent applications for articles and/or methods of use in the United States and/or other countries.

Note

This product shall be manufactured by Victaulic or to Victaulic specifications. All products to be installed in accordance with current Victaulic installation/assembly instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.

Installation

Reference should always be made to the Victaulic installation handbook or installation instructions of the product you are installing. Handbooks are included with each shipment of Victaulic products, providing complete installation and assembly data, and are available in PDF format on WeChat.

Warranty

Refer to the Warranty section of the current Price List or contact Victaulic for details.

Trademarks

Victaulic and all other Victaulic marks are the trademarks or registered trademarks of Victaulic Company, and/or its affiliated entities, in the U.S. and/or other countries.

Victaulic® FireLock™ Installation-Ready™ Rigid Couplings

Style 009N and Style 109



Patented



Patented

1.0 PRODUCT DESCRIPTION

Available Sizes

- Style 009N: 1 ¼ – 12"/DN32 – DN300
- Style 109: 1 ¼ – 4"/DN32 – DN100

Pipe Material

- Schedule 10, Schedule 40 or specialty carbon steel pipe listed in Section 5. For use with alternative materials and wall thicknesses please contact Victaulic
- For exceptions reference section 6.0 Notifications

Maximum Working Pressure

- Accommodates pressures ranging from full vacuum (29.9 in Hg/760 mm Hg) to 365 psi/2517 kPa

Function

- Joins carbon steel pipe with grooved ends conforming to [publication 25.01](#)
- Provides a rigid pipe joint designed to restrict axial or angular movement

2.0 CERTIFICATION/LISTINGS



LPS 1219: Issue 3.1
Cert/LPCB Ref. 104-1a/36



EN 10311
Regulation (EU)
No. 305/2011

ALWAYS REFER TO ANY NOTIFICATIONS AT THE END OF THIS DOCUMENT REGARDING PRODUCT INSTALLATION, MAINTENANCE OR SUPPORT.



3.0 SPECIFICATIONS – MATERIAL

Housing: Ductile iron conforming to ASTM A 536, Grade 65-45-12. Ductile iron conforming to ASTM A 395, Grade 65-45-15, is available upon special request.

Housing Coating: (specify choice)

Orange coating

Red coating (standard for EMEA-I and Asia Pacific)

Optional for Style 009N: Hot Dipped Galvanized per ASTM A123

Optional for Style 109: Mechanically Galvanized per ASTM B695 (available only in North America and Latin America).

Gasket: (specify choice)

Grade “E” EPDM (Type A) Vic-Plus™ Pre-lubricated Gasket

EPDM (Violet Color Code). Applicable for wet and dry (oil-free air) fire protection systems only. Listed/Approved for continuous use in wet and dry systems. Listed/Approved for dry systems at -40°F/-40°C and above. Not compatible for use with hot water services or steam services.

NOTES

- Reference should always be made to [publication I-100](#), Victaulic Field Installation Handbook for gasket lubrication instructions.
- Services listed are General Service Guidelines only. It should be noted that there are services for which these gaskets are not compatible. Reference should always be made to [publication 05.01](#), Victaulic Gasket Selection Guide for specific gasket service guidelines and for a listing of services which are not compatible.

Bolts/Nuts: (specify choice)

Standard: Carbon steel oval neck track bolt(s) meeting the mechanical property requirements of ASTM A449 (imperial) and ISO 898-1 Class 9.8 (M10-M16) Class 8.8 (M20 and greater). Carbon steel hex nuts meeting the mechanical property requirements of ASTM A563 Grade B (imperial) and ASTM A563M Class 9 (metric). Track bolts and hex nuts are zinc electroplated per ASTM B633 Fe/Zn 5, finish Type III (imperial) or Type II (metric).


Optional for Style 009N: Stainless steel oval neck track bolts meeting the requirements of ASTM F593, Group 2 (316 stainless steel), condition CW. Stainless steel Heavy Hex nuts meeting the requirements of ASTM F594, Group 2 (316 stainless steel), condition CW, with galling-resistant coating.¹

¹ Optional bolts/nuts are available in imperial size only.

Coupling Linkage: High Strength Steel with comparable physical properties to that of the Track Bolt (ASTM A449). Linkage is zinc electroplated per ASTM B633 Fe/Zn 5, Type III Finish.

4.0 DIMENSIONS

Style 009N Two-Bolt Installation-Ready Coupling

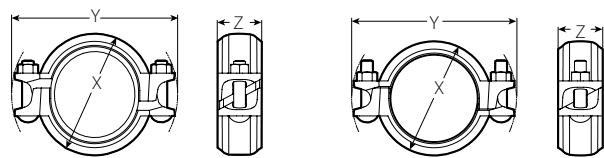

Style 009N Pre-Assembled

Style 009N Joint Assembled

Size		Maximum Working Pressure ²	Maximum End Load ²	Allow. Pipe End Separation ³	Bolt/Nut		Dimensions					Weight
Nominal	Actual Outside Diameter				Qty.	Size	Pre-assembled		Joint Assembled		Z	Approx. (Each)
							X	Y	X	Y		
inches DN	inches mm	psi kPa	lb N	inches mm		inches mm	inches mm	inches mm	inches mm	inches mm	lb kg	
1 ¼ DN32	1.660 42.4	365 2517	790 3514	0.10 2.54	2	¾ × 2 M10 x 51	3.13 79	5.00 127	2.75 70	5.00 127	2.00 51	1.4 0.6
1 ½ DN40	1.900 48.3	365 2517	1035 4604	0.10 2.54	2	¾ × 2 M10 x 51	3.38 86	5.13 130	3.00 76	5.13 130	2.00 51	1.5 0.7
2 DN50	2.375 60.3	365 2517	1617 7193	0.12 3.05	2	¾ × 2 ½ M10 x 63	4.00 102	5.63 143	3.50 89	5.63 143	2.00 51	1.9 0.9
2 ½	2.875 73.0	365 2517	2370 10542	0.12 3.05	2	¾ × 2 ½ M10 x 63	4.50 114	6.13 156	4.00 102	6.13 156	2.00 51	2.1 1.0
DN65	3.000 76.1	365 2517	2580 11476	0.12 3.05	2	¾ × 2 ½ M10 x 63	4.63 118	6.00 152	4.13 105	6.13 156	2.00 51	2.1 1.0
3 DN80	3.500 88.9	365 2517	3512 15622	0.12 3.05	2	¾ × 2 ½ M10 x 63	5.13 130	6.75 171	4.63 117	6.75 171	2.00 51	2.3 1.0
4 DN100	4.500 114.3	365 2517	5805 25822	0.17 4.32	2	¾ × 2 ½ M10 x 63	6.00 152	7.88 200	5.63 143	7.50 191	2.13 54	2.9 1.3
	4.250 108.0	365 2517	5178 23020	0.17 4.32	2	¾ × 2 ½ M10 x 63	5.63 152	7.38 187	5.38 137	7.38 187	2.13 54	3.1 1.4
5	5.563 141.3	365 2517	8872 39456	0.17 4.32	2	½ × 3 M12 x 76	7.25 184	9.25 235	6.75 171	9.13 232	2.25 57	5.0 2.3
	5.250 133.0	365 2517	7901 35106	0.17 4.32	2	½ × 3 M12 x 76	6.63 168	9.00 229	6.38 162	9.00 229	2.25 57	4.8 2.2
DN125	5.500 139.7	365 2517	8672 38529	0.17 4.32	2	½ × 3 M12 x 76	6.88 175	9.25 235	6.75 171	9.13 232	2.25 57	4.9 2.2
6 DN150	6.625 168.3	365 2517	12582 44469	0.17 4.32	2	½ × 3 ¼ M12 x 83	8.38 213	10.38 264	7.88 200	10.13 257	2.25 57	6.0 2.7
	6.250 159.0	365 2517	11198 49753	0.17 4.32	2	½ × 3 ¼ M12 x 83	7.88 200	10.00 254	7.38 187	9.88 251	2.25 57	5.6 2.5
	6.500 165.1	365 2517	12112 53813	0.17 4.32	2	½ × 3 ¼ M12 x 83	8.00 203	10.25 260	7.75 197	10.13 257	2.25 57	6.0 2.7
8 DN200	8.625 219.1	365 2517	21326 94863	0.17 4.32	2	¾ × 4 M16 x 101	10.88 276	13.38 340	10.25 260	13.13 333	2.50 64	11.4 5.2
	8.500 216.0	365 2517	20712 55968	0.17 4.32	2	¾ × 4 M16 x 101	10.63 270	13.25 337	10.25 260	10.13 257	2.63 67	11.4 5.2
10 DN250	10.750 273.0	300 2068	27229 121121	0.25 6.4	2	7/8 × 6 ½ M22 x 165	13.75 349	17.00 432	13.25 337	17.13 435	2.75 70	22.6 10.3
12 DN300	12.750 323.9	300 2068	38303 170380	0.25 6.4	2	7/8 × 6 ½ M22 x 165	16.00 406	19.00 483	15.50 394	19.13 486	2.75 70	27.6 12.5

² Working Pressure and End Load are total, from all internal and external loads, based on standard weight (ANSI) steel pipe, standard roll or cut grooved in accordance with Victaulic specifications. See the Listings/Approvals section of this publication for ratings on other pipe.


³ The allowable pipe separation dimension shown is for system layout purposes only. Style 009N couplings are considered rigid connections and will not accommodate expansion or contraction of the piping system.

NOTES

- When assembling Style 009N or Style 109 couplings onto end caps, take additional care to make certain the end cap is fully seated against the gasket end stop. For Style 009N or Style 109 couplings, use FireLock No. 006 end caps containing the "EZ" marking on the inside face or No. 60 end caps containing the "QV EZ" marking on the inside face. Non-Victaulic end cap products shall not be used with Style 009N or Style 109 couplings. IMPORTANT: Gaskets intended for the Style 009 or Style 009V couplings cannot be used with the Style 009N or Style 109 coupling. There is no interchanging of gaskets or housings between coupling styles.
- Use Of FlushSeal Gaskets For Dry Pipe Systems** Style 009N or Style 109 couplings are supplied with Grade "E" Type A gaskets. These gaskets include an integral pipe stop, that once installed provides the similar benefits as a FlushSeal gasket for dry pipe systems. It should be noted that standard Victaulic FlushSeal gaskets cannot be used with the Style 009N or Style 109 couplings.
- The Allowable Pipe End Separation dimension shown is for system layout purposes only. Style 009N or Style 109 Installation-Ready rigid couplings are considered rigid connections and will not accommodate expansion/contraction or angular movement of the piping system. Contact Victaulic for torsional resistance information.

4.1 DIMENSIONS

Style 109 One-Bolt *Installation-Ready* Coupling

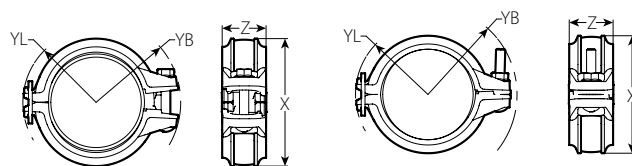

Style 109 Pre-Assembled

Style 109 Joint Assembled

Size		Max. Working Pressure	Max. End Load	Allow. Pipe End Sep. Maximum	Bolt/Nut		Dimensions								Weight
Nominal	Actual Outside Diameter				Qty.	Size	Pre-Assembled				Assembled				Approx (Each)
							YL	YB	X	Z	YL	YB	X	Z	
inches DN	inches mm	psi kPa	Lbs. N	inches mm		inches mm	inches mm	inches mm	inches m m	inches mm	inches mm	inches mm	inches mm	lb kg	
1 ¼ DN32	1.660 42.4	365 2517	790 3514	0.10 2.54	1	¾ x 2 ¼ M10 x 57	1.97 50	2.49 63	3.17 81	1.95 50	1.93 49	2.59 66	2.84 72	1.95 50	1.5 0.7
1 ½ DN40	1.900 48.3	365 2517	1035 4603	0.10 2.54	1	¾ x 2 ¼ M10 x 57	2.13 54	2.60 66	3.41 87	1.95 50	2.1 53	2.68 68	3.07 78	1.95 50	1.6 0.7
2 DN50	2.375 60.3	365 2517	1617 7192	0.12 3.048	1	¾ x 2 ¼ M10 x 57	2.32 59	2.85 72	3.76 96	1.98 50	2.29 58	2.95 75	3.45 88	1.98 50	1.9 0.9
2 ½	2.875 73.0	365 2517	2370 10540	0.12 3.048	1	¾ x 2 ¼ M10 x 57	2.63 67	3.09 78	4.29 109	1.99 51	2.61 66	3.15 80	3.93 100	1.99 51	2.1 1.0
DN65	3.000 76.1	365 2517	2580 11476	0.12 3.048	1	7⁄₁₆ x 2 ¾ M11 x 69	2.68 68	3.22 82	4.56 116	2.03 52	2.64 67	3.45 88	4.22 107	2.03 52	2.4 1.1
3 DN80	3.500 88.9	365 2517	3512 15620	0.12 3.048	1	7⁄₁₆ x 2 ¾ M11 x 69	2.93 74	3.53 90	5.13 130	2.07 53	2.89 73	3.78 96	4.67 119	2.07 53	2.7 1.2
4 DN100	4.500 114.3	300 2068	4771 21223	0.17 4.318	1	7⁄₁₆ x 2 ¾ M11 x 69	3.47 88	4.01 102	6.03 153	2.08 53	3.43 87	4.22 107	5.56 141	2.08 53	3.5 1.6

⁴ Working Pressure and End Load are total, from all internal and external loads, based on standard weight (ANSI) steel pipe, standard roll or cut grooved in accordance with Victaulic specifications. See the Listings/Approvals section of this publication for ratings on other pipe.

⁵ The allowable pipe separation dimension shown is for system layout purposes only. Style 109 couplings are considered rigid connections and will not accommodate expansion or contraction of the piping system.

NOTES

- When assembling Style 009N or Style 109 couplings onto end caps, take additional care to make certain the end cap is fully seated against the gasket end stop. For Style 009N or Style 109 couplings, use FireLock No. 006 end caps containing the "EZ" marking on the inside face or No. 60 end caps containing the "QV EZ" marking on the inside face. Non-Victaulic end cap products shall not be used with Style 009N or Style 109 couplings. IMPORTANT: Gaskets intended for the Style 009 or Style 009V couplings cannot be used with the Style 009N or Style 109 coupling. There is no interchanging of gaskets or housings between coupling styles.
- Use Of FlushSeal Gaskets For Dry Pipe Systems** Style 009N or Style 109 couplings are supplied with Grade "E" Type A gaskets. These gaskets include an integral pipe stop, that once installed provides the similar benefits as a FlushSeal gasket for dry pipe systems. It should be noted that standard Victaulic FlushSeal gaskets cannot be used with the Style 009N or Style 109 couplings.
- The Allowable Pipe End Separation dimension shown is for system layout purposes only. Style 009N or Style 109 Installation-Ready rigid couplings are considered rigid connections and will not accommodate expansion/contraction or angular movement of the piping system. Contact Victaulic for torsional resistance information.

5.0 PERFORMANCE

Style 009N Two-Bolt *Installation-Ready* Coupling Listings/Approvals⁶

The information provided below is based on the latest listing and approval data at the time of publication. Listings/Approvals are subject to change and/or additions by the approval agencies. Contact Victaulic for performance on other pipe and the latest listings and approvals.

Size		cULus		FM		VdS	LPCB
Nominal	Actual Outside Diameter	Sch. 10	Sch. 40	Sch. 10	Sch. 40		
inches DN	inches mm	psi kPa bar	psi kPa bar	psi kPa bar	psi kPa bar	psi kPa bar	psi kPa bar
1 ¼ DN32	1.660 42.4	365 2517 25	365 2517 25	363 2503 25	363 2503 25	363 2500 25	363 2500 25
1 ½ DN40	1.900 48.3	365 2517 25	365 2517 25	363 2503 25	363 2503 25	363 2500 25	363 2500 25
2 DN50	2.375 60.3	365 2517 25	365 2517 25	363 2503 25	363 2503 25	363 2500 25	363 2500 25
2 ½	2.875 73.0	365 2517 25	365 2517 25	363 2503 25	363 2503 25	– – –	363 2500 25
DN65	3.000 76.1	365 ⁷ 2517 ⁷ 25 ⁷	– – –	363 ⁸ 2503 ⁸ 25 ⁸	– – –	363 2500 25	363 2500 25
3 DN80	3.500 88.9	365 2517 25	365 2517 25	363 2503 25	363 2503 25	363 2500 25	363 2500 25
	4.250 108.0	– – –	– – –	363 2503 25	363 2503 25	– – –	– – –
4 DN100	4.500 114.3	365 2517 25	365 2517 25	363 2503 25	363 2503 25	363 2500 25	363 2500 25
	5.250 133.0	– – –	– – –	363 ⁸ 2503 ⁸ 25 ⁸	– – –	– – –	– – –
DN125	5.500 139.7	290 ⁹ 2000 ⁹ 20 ⁹	– – –	363 ⁸ 2503 ⁸ 25 ⁸	– – –	232 1600 16	363 2500 25
5	5.563 141.3	290 2000 20	365 2517 25	363 2503 25	363 2503 25	232 1600 16	363 2500 25
	6.250 159	– – –	– – –	363 ⁸ 2503 ⁸ 25 ⁸	– – –	– – –	– – –
	6.500 165.1	290 ¹⁰ 2000 ¹⁰ 20 ¹⁰	– – –	363 ⁸ 2503 ⁸ 25 ⁸	– – –	– – –	363 2500 25

⁶ Listed/Approved for continuous use in wet and dry systems. Listed/Approved for dry systems -40° F/C and above. Please see the [Victaulic Installation Manual I-009N](#) for details concerning when supplemental lubrication is required.

⁷ cULus listed for DIN 2458 (EN 10220) 2.6 mm pipe wall.

⁸ FM approved for BS 1387 (EN 10255) Medium 3.6 mm pipe wall.

⁹ cULus listed for EN 10220 4.0 mm pipe wall.

¹⁰ cULus listed for EN 10255 4.5 mm pipe wall.

¹¹ With optional stainless steel fasteners, cULus Listed to 175psi/1207 kPa/12 bar and FM Approved to the FM ratings shown in the above table. The stainless steel fasteners have a marking designation of "316" on the end face of the bolt.

¹² FM approved for 0.188" pipe wall.

¹³ cULus listed for 0.188" pipe wall.

5.0 PERFORMANCE (CONTINUED)

Style 009N Two-Bolt *Installation-Ready Coupling Listings/Approvals*⁶

The information provided below is based on the latest listing and approval data at the time of publication. Listings/Approvals are subject to change and/or additions by the approval agencies. Contact Victaulic for performance on other pipe and the latest listings and approvals.

Size		cULus		FM		VdS	LPCB
Nominal	Actual Outside Diameter	Sch. 10	Sch. 40	Sch. 10	Sch. 40		
inches DN	inches mm	psi kPa bar	psi kPa bar	psi kPa bar	psi kPa bar	psi kPa bar	psi kPa bar
6 DN150	6.625 168.3	300 2068 20	365 2517 25	300 2068 20	363 2503 25	232 1600 16	363 2500 25
	8.515 216.3	290 2000 20	– – –	363 ⁸ 2503 ⁸ 25 ⁸	– – –	– – –	– – –
8 DN200	8.625 219.1	300 2068 20	365 2517 25	300 ¹² 2068 ¹² 20 ¹²	363 2503 25	232 1600 16	363 2500 25
10 DN250	10.750 273.0	300 ¹³ 2068 ¹³ 20 ¹³	300 2068 20	300 ¹² 2068 ¹² 20 ¹²	300 2068 20	– – –	– – –
12 DN300	12.750 323.9	300 ¹³ 2068 ¹³ 20 ¹³	300 2068 20	250 ¹² 1720 ¹² 17 ¹²	300 2068 20	– – –	– – –

⁶ Listed/Approved for continuous use in wet and dry systems. Listed/Approved for dry systems -40° F/C and above. Please see the [Victaulic Installation Manual I-009N](#) for details concerning when supplemental lubrication is required.

⁷ cULus listed for DIN 2458 (EN 10220) 2.6 mm pipe wall.

⁸ FM approved for BS 1387 (EN 10255) Medium 3.6 mm pipe wall.

⁹ cULus listed for EN 10220 4.0 mm pipe wall.

¹⁰ cULus listed for EN 10255 4.5 mm pipe wall.

¹¹ With optional stainless steel fasteners, cULus Listed to 175psi/1207 kPa/12 bar and FM Approved to the FM ratings shown in the above table. The stainless steel fasteners have a marking designation of "316" on the end face of the bolt.

¹² FM approved for 0.188" pipe wall.

¹³ cULus listed for 0.188" pipe wall.

5.1 PERFORMANCE

Style 109 One-Bolt *Installation-Ready Coupling Listings/Approvals*¹⁵

The information provided below is based on the latest listing and approval data at the time of publication. Listings/Approvals are subject to change and/or additions by the approvals agencies. Contact Victaulic for performance on other pipe and the latest listings and approvals.

Size		cULus		FM		VdS	LPCB
Nominal inches DN	Actual Outside Diameter inches mm	Sch. 10 psi kPa bar	Sch. 40 psi kPa bar	Sch. 10 psi kPa bar	Sch. 40 psi kPa bar	psi kPa bar	psi kPa bar
1 ¼ DN32	1.660 42.4	365 2517 25	365 2517 25	365 2517 25	365 2517 25	232 1600 16	363 2503 25
1 ½ DN40	1.900 48.3	365 2517 25	365 2517 25	365 2517 25	365 2517 25	232 1600 16	363 2503 25
2 DN50	2.375 60.3	365 2517 25	365 2517 25	365 2517 25	365 2517 25	232 1600 16	363 2503 25
2 ½	2.875 73.0	365 2517 25	365 2517 25	365 2517 25	365 2517 25	– – –	– – –
DN65	3.000 76.1	365 2517 25	365 2517 25	365 2517 25	365 2517 25	232 1600 16	363 2503 25
3 DN80	3.500 88.9	365 2517 25	365 2517 25	365 2517 25	365 2517 25	232 1600 16	363 2503 25
4 DN100	4.500 114.3	300 2068 20	365 2517 25	300 2068 20	300 2068 20	– – –	290 2000 20

¹⁵ Listed/Approved for continuous use in wet and dry systems. Listed/Approved for dry systems -40° F/C and above. Please see the Victaulic [Installation Manual I-109](#) for details concerning when supplemental lubrication is required.

5.2 PERFORMANCE

Specialty Pipe

Style 009N Two-Bolt *Installation-Ready* Coupling Listings/Approvals

Pipe Type	Size	Pressure Rating	
	inches DN	cULus psi kPa bar	FM psi kPa bar
EF	1 ¼ – 4 DN32 – DN100	300 2068 20	N/A
EL	1 ¼ – 2 DN32 – DN50	300 2068 20	300 2068 20
ET40	1 ¼ – 2 DN32 – DN50	300 2068 20	N/A
EZF	3 – 4 DN80 – DN100	300 2068 20	N/A
EZT	1 ¼ – 2 DN32 – DN50	300 2068 20	300 2068 20
FF	1 ½ – 4 DN40 – DN100	300 2068 20	N/A
GL	1 ¼ – 2 DN32 – DN50	300 2068 20	300 2068 20
MF	1 ¼ – 4 DN32 – DN100	300 2068 20	300 2068 20
	6 DN150	175 1205 12	175 1205 12
MT	1 ¼ – 2 DN32 – DN50	300 2068 20	300 2068 20
MLT	1 ¼ – 2 DN32 – DN50	N/A	300 2068 20
TF	2 ½ – 4 73.0 mm – DN100	N/A	300 2068 20
WG5, WG5E, WF5, WG7, WG7E, WL7	1 ¼ – 4 DN32 – DN100	175 1205 12	300 2068 20
WLS	1 ¼ – 2 DN32 – DN50	300 2068 20	300 2068 20

NOTES

- EF = EDDY FLOW steel pipe manufactured by Bull Moose Tube Co.
- EL = EDDYLITE steel pipe manufactured by Bull Moose Tube Co.
- ET40 = Eddythread 40 steel pipe manufactured by Bull Moose Tube Co.
- EZF = EZ-Flow steel pipe manufactured by Northwest Pipe Co.
- EZT = EZ-Thread steel pipe manufactured by Youngstown Tube Co.
- FF = Fire-Flo steel pipe manufactured by Youngstown Tube Co.
- GL = GL steel pipe manufactured by Wheatland Tube Co.
- MF = Mega-Flow steel pipe manufactured by Wheatland Tube Co.
- MT = Mega-Thread steel pipe manufactured by Wheatland Tube Co.
- MLT = MLT steel pipe manufactured by Wheatland Tube Co.
- TF = Tex-Flow steel pipe manufactured by Tex-Tube Co.
- WG5, WG5E, WF5 = WGalweld 5, WGalweld 5E, WFlow 5 steel pipe manufactured by Wuppermann Stahl GmbH.
- WG7, WG7E, WL7 = WGalweld 7, WGalweld 7E, WLight 7 steel pipe manufactured by Wuppermann Stahl GmbH
- WLS = WLS steel pipe manufactured by Wheatland Tube Co.

5.3 PERFORMANCE

Specialty Pipe

Style 109 One-Bolt *Installation-Ready* Coupling Listings/Approvals

Pipe Type	Size	Pressure Rating	
	inches	cULus psi kPa bar	FM psi kPa bar
	DN		
EF	1 ¼ – 2 ½ DN32 – 73.0 mm	N/A	300 2068 20
	1 ½ – 2 ½ DN40 – 73.0 mm	300 2068 20	N/A
	3 – 4 DN80 – DN100	300 2068 20	300 2068 20
Easy-Flow	1 ¼ – 2 DN32 – DN50	N/A	300 2068 20
	3 – 4 DN80 – DN100	N/A	300 2068 20
EL	1 ¼ – 2 DN32 – DN50	N/A	300 2068 20
ET40	1 ¼ – 2 DN32 – DN50	300 2068 20	300 2068 20
EZT	1 ¼ – 2 DN32 – DN50	N/A	300 2068 20
	1 ½ – 2 DN40 – DN50	300 2068 20	N/A
FF	1 ½ – 4 DN40 – DN100	300 2068 20	300 2068 20
GL	1 ¼ – 2 DN32 – DN50	N/A	300 2068
MF	1 ¼ – 4 DN32 – DN100	300 2068 20	300 2068 20
MT	1 ¼ – 2 DN32 – DN50	300 2068 20	300 2068 20
MLT	1 ¼ – 2 DN32 – DN50	300 2068 20	300 2068 20

NOTES

- EF = EDDY FLOW steel pipe manufactured by Bull Moose Tube Co.
- Easy-Flow = Easy-Flow steel pipe manufactured by Borusan Mannesmann Boru.
- EL = EDDYLITE steel pipe manufactured by Bull Moose Tube Co.
- ET40 = Eddythread 40 steel pipe manufactured by Bull Moose Tube Co.
- EZT = EZ-Thread steel pipe manufactured by Youngstown Tube Co.
- FF = Fire-Flo steel pipe manufactured by Youngstown Tube Co.
- GL = GL steel pipe manufactured by Wheatland Tube Co.
- MF = Mega-Flow steel pipe manufactured by Wheatland Tube Co.
- MT = Mega-Thread steel pipe manufactured by Wheatland Tube Co.
- MLT = MLT steel pipe manufactured by Wheatland Tube Co.
- TF = Tex-Flow steel pipe manufactured by Tex-Tube Co.
- WG7, WG7E = WGalweld 7 and WGalweld 7E steel pipe manufactured by Wuppermann Stahl GmbH.
- WLS = WLS steel pipe manufactured by Wheatland Tube Co.

5.3 PERFORMANCE (CONTINUED)

Specialty Pipe

Style 109 One-Bolt *Installation-Ready* Coupling Listings/Approvals

Pipe Type	Size	Pressure Rating	
	inches	cULus psi kPa bar	FM psi kPa bar
	DN		
TF	2 ½ – 4 73.00 mm – DN100	N/A	300 2068 20
WG7, WG7E	1 ¼ – 2 DN32 – DN50	N/A	300 2068 20
	3 – 4 DN80 – DN100	N/A	300 2068 20
WLS	1 ¼ – 2 DN32 – DN50	N/A	300 2068 20

NOTES

- EF = EDDY FLOW steel pipe manufactured by Bull Moose Tube Co.
- Easy-Flow = Easy-Flow steel pipe manufactured by Borusan Mannesmann Boru.
- EL = EDDYLITE steel pipe manufactured by Bull Moose Tube Co.
- ET40 = Eddythread 40 steel pipe manufactured by Bull Moose Tube Co.
- EZT = EZ-Thread steel pipe manufactured by Youngstown Tube Co.
- FF = Fire-Flo steel pipe manufactured by Youngstown Tube Co.
- GL = GL steel pipe manufactured by Wheatland Tube Co.
- MF = Mega-Flow steel pipe manufactured by Wheatland Tube Co.
- MT = Mega-Thread steel pipe manufactured by Wheatland Tube Co.
- MLT = MLT steel pipe manufactured by Wheatland Tube Co.
- TF = Tex-Flow steel pipe manufactured by Tex-Tube Co.
- WG7, WG7E = WGalweld 7 and WGalweld 7E steel pipe manufactured by Wuppermann Stahl GmbH.
- WLS = WLS steel pipe manufactured by Wheatland Tube Co.

6.0 NOTIFICATIONS

WARNING



- Read and understand all instructions before attempting to install any Victaulic products.
- Always verify that the piping system has been completely depressurized and drained immediately prior to installation, removal, adjustment, or maintenance of any Victaulic products.
- Wear safety glasses, hardhat, and foot protection.

Failure to follow these instructions could result in death or serious personal injury and property damage.

- These products shall be used only in fire protection systems that are designed and installed in accordance with current, applicable National Fire Protection Association (NFPA 13, 13D, 13R, etc.) standards, or equivalent standards, and in accordance with applicable building and fire codes. These standards and codes contain important information regarding protection of systems from freezing temperatures, corrosion, mechanical damage, etc.
- The installer shall understand the use of this product and why it was specified for the particular application.
- The installer shall understand common industry safety standards and potential consequences of improper product installation.
- It is the system designer's responsibility to verify suitability of materials for use with the intended fluid media within the piping system and external environment.
- The material specifier shall evaluate the effect of chemical composition, pH level, operating temperature, chloride level, oxygen level, and flow rate on materials to confirm system life will be acceptable for the intended service.

Failure to follow installation requirements and local and national codes and standards could compromise system integrity or cause system failure, resulting in death or serious personal injury and property damage.

NOTICE

- Victaulic does not recommend the use of any furnace butt-welded pipe with sizes 2"/DN50 and smaller Victaulic gasketed joint products. This includes, but is not limited to, ASTM A53 Type F pipe.

7.0 REFERENCE MATERIALS

[05.01: Seal Selection Guide](#)

[25.01: Original Groove System \(OGS\) Groove Specifications](#)

[I-009N: Installation Instructions FireLock EZ™ Rigid Coupling Style 009N](#)

[I-100: Victaulic Field Installation Handbook](#)

[I-109: Installation Instructions FireLock™ One-Bolt Rigid Coupling Style 109](#)

[I-ENDCAP: Victaulic End Caps Installation Instructions](#)

[I-IMPACT: Impact Tool Usage Guidelines](#)

[AN-001: Application Notification - Potential Incompatibility of Type F Pipe, Sizes NPS 2" | DN50 and Smaller](#)

User Responsibility for Product Selection and Suitability

Each user bears final responsibility for making a determination as to the suitability of Victaulic products for a particular end-use application, in accordance with industry standards and project specifications, and the applicable building codes and related regulations as well as Victaulic performance, maintenance, safety, and warning instructions. Nothing in this or any other document, nor any verbal recommendation, advice, or opinion from any Victaulic employee, shall be deemed to alter, vary, supersede, or waive any provision of Victaulic Company's standard conditions of sale, installation guide, or this disclaimer.

Intellectual Property Rights

No statement contained herein concerning a possible or suggested use of any material, product, service, or design is intended, or should be construed, to grant any license under any patent or other intellectual property right of Victaulic or any of its subsidiaries or affiliates covering such use or design, or as a recommendation for the use of such material, product, service, or design in the infringement of any patent or other intellectual property right. The terms "Patented" or "Patent Pending" refer to design or utility patents or patent applications for articles and/or methods of use in the United States and/or other countries.

Note

This product shall be manufactured by Victaulic or to Victaulic specifications. All products to be installed in accordance with current Victaulic installation/assembly instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.

Installation

Reference should always be made to the Victaulic installation handbook or installation instructions of the product you are installing. Handbooks are included with each shipment of Victaulic products, providing complete installation and assembly data, and are available in PDF format on our website at www.victaulic.com.

Warranty

Refer to the Warranty section of the current Price List or contact Victaulic for details.

Trademarks

Victaulic and all other Victaulic marks are the trademarks or registered trademarks of Victaulic Company, and/or its affiliated entities, in the U.S. and/or other countries.



1.0 PRODUCT DESCRIPTION

Available Sizes

- 1 ¼ – 8"/DN32 – DN200

Maximum Working Pressure

- Pressure ratings for Victaulic FireLock™ Fittings conform to the ratings of Victaulic FireLock EZ™ Style 009N couplings (refer to [publication 10.64](#) for more information).

Application

- FireLock™ fittings are designed for use exclusively with Victaulic couplings that have been Listed or Approved for Fire Protection Services. Use of other couplings or flange adapters may result in bolt pad interference.
- Connects pipe, provides change in direction and adapts sizes or components

Pipe Materials

- Carbon steel

2.0 CERTIFICATION/LISTINGS



EN 10311
Regulation (EU)
No. 305/2011

3.0 SPECIFICATIONS – MATERIAL

Fitting: Ductile iron conforming to ASTM A536, Grade 65-45-12.

Fitting Coating:

Orange enamel.


Red enamel in Europe, Middle East, Africa, and India.

Optional: Hot dipped galvanized.


ALWAYS REFER TO ANY NOTIFICATIONS AT THE END OF THIS DOCUMENT REGARDING PRODUCT INSTALLATION, MAINTENANCE OR SUPPORT.

System No.		Location		Spec Section		Paragraph	
Submitted By		Date		Approved		Date	


4.0 DIMENSIONS



No. 001



No. 003



No. 002



No. 006

Nominal Size inches DN	Actual Outside Diameter inches mm	No. 001 90° Elbow		No. 003 45° Elbow		No. 002 Straight Tee		No. 006 Cap	
		C to E inches mm	Approximate Weight Each lb kg	C to E inches mm	Approximate Weight Each lb kg	C to E inches mm	Approximate Weight Each lb kg	T inches mm	Approximate Weight Each lb kg
1 ¼ DN32	1.660 42.4	— —	— —	— —	— —	— —	— —	0.82 21	0.3 0.1
1 ½ DN40	1.900 48.3	— —	— —	— —	— —	— —	— —	0.82 21	0.4 0.2
2 DN50	2.375 60.3	2.75 70	1.7 0.8	2.00 51	1.8 0.8	2.75 70	2.4 1.1	0.88 22	0.6 0.3
2 ½	2.875 73.0	3.00 76	3.1 1.4	2.25 57	2.2 1.0	3.00 76	3.6 1.6	0.88 22	1.0 0.5
DN65	3.000 76.1	3.00 76	3.30 1.5	2.25 57	2.4 1.1	3.00 76	3.8 1.7	— —	— —
3 DN80	3.500 88.9	3.38 86	4.0 1.8	2.50 64	3.1 1.4	3.38 86	5.3 2.4	0.88 22	1.2 0.5
	4.250 108.0	4.00 102	5.7 2.6	3.00 76	5.1 2.3	4.00 102	7.5 3.4	— —	— —
4 DN100	4.500 114.3	4.00 102	6.7 3.0	3.00 76	5.6 2.5	4.00 102	8.7 3.9	1.00 25	2.4 1.1
5	5.563 141.3	4.88 124	12.6 5.7	3.25 83	8.3 3.8	4.88 124	15.7 7.1	1.00 25	4.1 1.9
DN125	5.500 139.7	4.88 124	12.4 5.6	3.25 82.6	8.2 3.7	4.88 124	15.4 6.9	— —	— —
	6.250 158.8	5.50 140	12.6 5.7	3.50 89	9.2 4.2	5.50 140	17.9 8.0	— —	— —
6 DN150	6.625 168.3	5.50 140	18.3 8.3	3.50 89	11.7 5.3	5.50 140	22.7 10.3	1.00 25	5.9 2.7
	6.500 165.1	5.43 140	17.6 7.9	3.50 89	11.4 5.2	5.50 140	22.0 9.9	— —	— —
8 DN200	8.625 219.1	6.81 173	25.5 11.6	4.25 108	20.4 9.3	6.94 176	38.7 17.6	1.13 29	12.7 5.8
	8.515 216.3	6.81 173	23.1 10.5	— —	— —	6.94 176	33.6 15.2	— —	— —

5.0 PERFORMANCE

Flow Data

Size		Frictional Resistance Equivalent of Straight Pipe ¹			
Nominal Size inches DN	Actual Outside Diameter inches mm	Elbows		No. 002 Straight Tee	
		No. 001 90° Elbow feet meters	No. 003 45° Elbow feet meters	Branch feet meters	Run feet meters
1 ¼ DN32	1.660 42.4	— —	— —	— —	— —
1 ½ DN40	1.900 48.3	— —	— —	— —	— —
2 DN50	2.375 60.3	3.5 1.1	1.8 0.5	8.5 2.6	3.5 1.1
2 ½	2.875 73.0	4.3 1.3	2.2 0.7	10.8 3.3	4.3 1.3
DN65	3.000 76.1	4.5 1.4	2.3 0.7	11.0 3.4	4.5 1.4
3 DN80	3.500 88.9	5.0 1.5	2.6 0.8	13.0 4.0	5.0 1.5
	4.250 108.0	6.4 2.0	3.2 0.9	15.3 4.7	6.4 2.0
4 DN100	4.500 114.3	6.8 2.1	3.4 1.0	16.0 4.9	6.8 2.1
5	5.563 141.3	8.5 2.6	4.2 1.3	21.0 6.4	8.5 2.6
DN125	5.500 139.7	8.3 2.5	4.1 1.3	20.6 6.3	8.3 2.5
	6.250 158.8	9.4 2.9	4.9 1.5	25.0 7.6	9.6 2.9
6 DN150	6.625 168.3	10.0 3.0	5.0 1.5	25.0 7.6	10.0 3.0
	6.500 165.1	9.8 3.0	4.9 1.5	24.5 7.5	9.8 3.0
8 DN200	8.625 219.1	13.0 4.0	5.0 1.5	33.0 10.1	13.0 4.0
	8.515 216.3	13.0 4.0	— —	33.0 10.1	13.0 4.0

¹ The flow data listed is based upon the pressure drop of Schedule 40 pipe.

6.0 NOTIFICATIONS

General Notes

NOTE: When assembling FireLock EZ™ couplings onto end caps, take additional care to make certain the end cap is fully seated against the gasket end stop. For FireLock EZ™ Style 009N/009H couplings, use FireLock™ No. 006 end caps containing the “EZ” marking on the inside face or No. 60 end caps containing the “QV EZ” marking on the inside face. Non-Victaulic end cap products shall not be used with Style 009/009V/009H/009N couplings.

7.0 REFERENCE MATERIALS

[10.64: Victaulic® FireLock™ Rigid Coupling Style 009N](#)

[10.02: Victaulic® FireLock™ Rigid Coupling Style 005H with Vic-Plus™ Gasket System](#)

[29.01: Victaulic® Terms and Conditions of Sale](#)

User Responsibility for Product Selection and Suitability

Each user bears final responsibility for making a determination as to the suitability of Victaulic products for a particular end-use application, in accordance with industry standards and project specifications, and the applicable building codes and related regulations as well as Victaulic performance, maintenance, safety, and warning instructions. Nothing in this or any other document, nor any verbal recommendation, advice, or opinion from any Victaulic employee, shall be deemed to alter, vary, supersede, or waive any provision of Victaulic Company's standard conditions of sale, installation guide, or this disclaimer.

Intellectual Property Rights

No statement contained herein concerning a possible or suggested use of any material, product, service, or design is intended, or should be construed, to grant any license under any patent or other intellectual property right of Victaulic or any of its subsidiaries or affiliates covering such use or design, or as a recommendation for the use of such material, product, service, or design in the infringement of any patent or other intellectual property right. The terms “Patented” or “Patent Pending” refer to design or utility patents or patent applications for articles and/or methods of use in the United States and/or other countries.

Note

This product shall be manufactured by Victaulic or to Victaulic specifications. All products to be installed in accordance with current Victaulic installation/assembly instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.

Installation

Reference should always be made to the Victaulic installation handbook or installation instructions of the product you are installing. Handbooks are included with each shipment of Victaulic products, providing complete installation and assembly data, and are available in PDF format on our website at www.victaulic.com.

Warranty

Refer to the Warranty section of the current Price List or contact Victaulic for details.

Trademarks

Victaulic and all other Victaulic marks are the trademarks or registered trademarks of Victaulic Company, and/or its affiliated entities, in the U.S. and/or other countries.

SECTION 2

HANGERS AND SWAY BRACING

Fig. 146

Continuous Threaded Rod

Size Range: 1/4" through 1 1/2" Stocked in six, ten, and twelve foot lengths. Other even foot lengths can be furnished to order.

Material: Carbon steel or Stainless Steel Gr 304

Threads: National Coarse (USS), rod threaded complete length.

Finish: ☐ Plain or ☐ Zinc Plated (Hot-Dip Galvanized optional)

Maximum Temperature: 650° F.

Ordering: Specify rod diameter and length, figure number, name and finish.

Note: The acceptability of galvanized coatings at temperatures above 450°F is at the discretion of the end user.

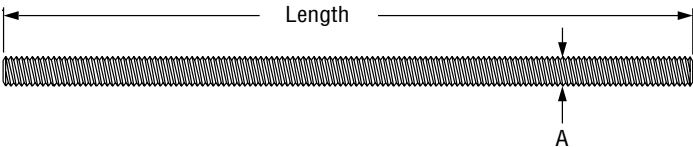


FIG. 146: LOADS (LBS) • WEIGHTS (LBS) • DIMENSIONS (IN)			
Rod Size A	Threads per Inch	Max Load 650° F	Weight per Ft.
1/4	20	240	0.12
3/8	16	730	0.30
1/2	13	1,350	0.53
5/8	11	2,160	0.84
3/4	10	3,230	1.20
7/8	9	4,480	1.70
1	8	5,900	2.30
1 1/4	7	9,500	3.60
1 1/2	6	13,800	5.10

Note: Other rod sizes available upon request. Class 2 fit is available upon request.

PROJECT INFORMATION		APPROVAL STAMP	
Project:		<input type="checkbox"/> Approved	
Address:		<input type="checkbox"/> Approved as noted	
Contractor:		<input type="checkbox"/> Not approved	
Engineer:		Remarks:	
Submittal Date:			
Notes 1:			
Notes 2:			

Fig. 92

Universal C-type Clamp (Standard Throat)

Size Range: 3/8" and 1/2"

Material: Ductile iron, hardened steel cup point set screw and locknut.

Finish: ☐ Plain or ☐ Galvanized

Service: Recommended for use under roof installations with bar joist type construction, or for attachment to the top or bottom flange of structural shapes where the vertical hanger rod is required to be offset from the edge of the flange and where the thickness of joist or flange does not exceed 3/4".

Approvals: Complies with Federal Specification A-A-1192A (Type 19 & 23) WW-H-171-E (Type 23), ANSI/MSS SP-69 and MSS SP-58 (Type 19 & 23).
UL, ULC Listed and FM Approved.

How to size: Size of clamp is determined by size of rod to be used.

Installation: Follow recommended set screw torque values per MSS-SP-69 (See table on page 208)

Features:

- They may be attached to horizontal flanges of structural members in either the top beam or bottom beam positions.
- Secured in place by a cup-pointed Set Screw tightened against the flange.
A Jam Nut is provided for tightening the Set Screw against the Body Casting.
- Thru tapping of the body casting permits extended adjustment of the threaded rod.
- Can be used with Fig 89X retaining clip for seismic applications.

Ordering: Specify rod size, figure number, name of clamp and finish.

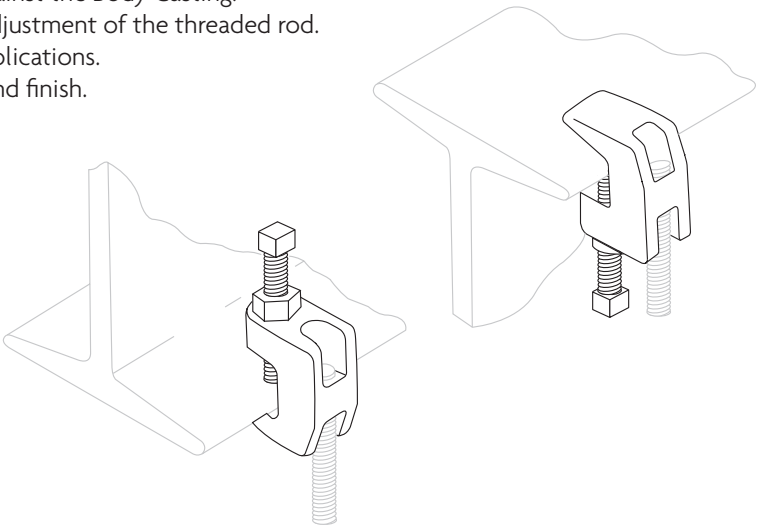
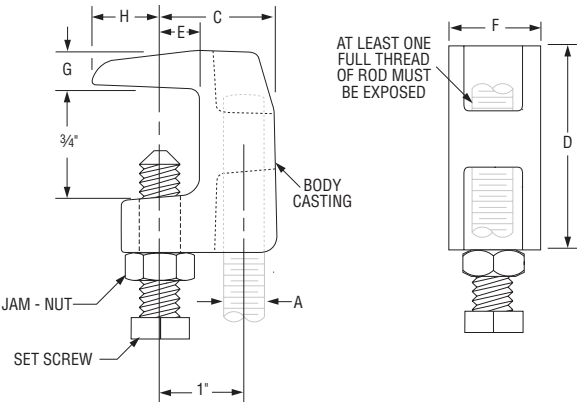


FIG. 92: LOAD (LBS) • WEIGHT (LBS) • DIMENSIONS (IN) • TORQUE (IN-LBS)											
Rod Size A	Set Screw Size	Torque Value	Max Loads ■		Weight	C	D	E	F	G	H
			Top	Bottom							
3/8	3/8	60	500	250	0.34	1 5/16	1 1/16	9/16	1 3/16	3/8	1/2
1/2	1/2	125	950	760	0.63	1 3/8	1 13/16	1/2	1 1/16	7/16	23/32

■ Maximum temperature of 450° F

PROJECT INFORMATION		APPROVAL STAMP	
Project:		<input type="checkbox"/> Approved	
Address:		<input type="checkbox"/> Approved as noted	
Contractor:		<input type="checkbox"/> Not approved	
Engineer:		Remarks:	
Submittal Date:			
Notes 1:			
Notes 2:			

Fig. 89X

Retaining Clip

Size Range: 3/8" through 3/4"
Material: Carbon steel
Finish: ☐ Plain or ☐ Galvanized
Service: For use with Figs. 86, 88, 92, 93, 94 & 95 in seismic applications.
Approvals: Complies with MSS-SP-127.
How to size: Specify length of retaining strap based on beam size.
Installation: Length of strap should be adequate to allow at least 1" of strap to be bent over the beam side of the flange opposite the side the beam clamp is mounted on.
Ordering: Specify rod size, figure number, name, length of retaining clip and finish
(Add 2" to flange width of beam to arrive at proper length of retaining clip).
If required length is not standard, order next longer standard.

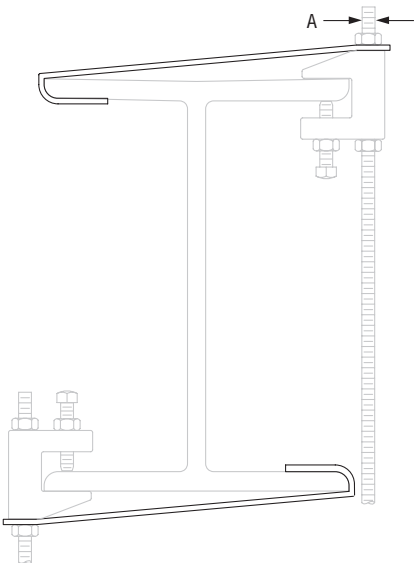
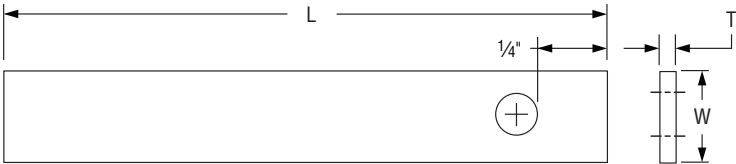



FIG. 89X: WEIGHT (LBS) • DIMENSIONS (IN)							
Rod Size A	Width W	T	Weight				Length L
			6	8	10	14	
3/8	1	0.058	0.10	0.14	0.17	0.24	6, 8, 10, 14
1/2							
5/8	1¼	0.070	0.13	0.17	0.22	0.31	
¾							

PROJECT INFORMATION		APPROVAL STAMP			
Project:		<input type="checkbox"/> Approved			
Address:		<input type="checkbox"/> Approved as noted			
Contractor:		<input type="checkbox"/> Not approved			
Engineer:		Remarks:			
Submittal Date:					
Notes 1:					
Notes 2:					

Fig. 69 Adjustable Swivel Ring, Tapped Per NFPA Standards

Size Range: 1/2" through 8"
Material: Carbon steel
Finish: ☐ Galvanized
Service: Recommended for suspension of non-insulated **stationary** pipe line.
Maximum Temperature: 650° F
Approvals: Complies with Federal Specification A-A-1192A (Type 10) WW-H-171-E (Type 10), ANSI/MSS SP-69 and MSS SP-58 (Type 10).
UL Listed and FM Approved (Sizes 3/4" - 8").
Features:

- Threads are countersunk so that they cannot become burred or damaged.
- Knurled swivel nut provides vertical adjustment after piping is in place.
- Captured swivel nut in the 1/2" through 6" sizes. The capture is permanent in the bottom portion of the band, allowing the hanger to be opened during installation if desired, but not allowing the nut to fall completely out.

Ordering: Specify size, figure number and name.
Note: The acceptability of galvanized coatings at temperatures above 450°F is at the discretion of the end user.
Metric nut available upon request. Non-captured nut also available upon request.

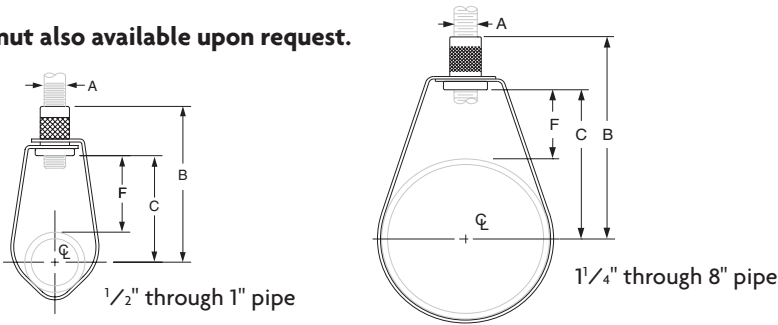


FIG. 69: LOADS (LBS) • WEIGHT (LBS) • DIMENSIONS (IN)						
Pipe Size	Max Load	Weight	Rod Size A	B	C	F
1/2	300	0.10	3/8	2 7/8	2	1 9/16
3/4		0.10		2 3/4	1 7/8	1 5/16
1		0.10		2 9/16	1 11/16	1
1 1/4		0.10		2 5/8	1 3/4	7/8
1 1/2		0.10		2 3/4	1 7/8	
2	525	0.11	3/8	3 1/4	2 3/8	1 1/8
2 1/2		0.20		4	2 3/4	1 5/16
3		0.20		3 13/16	2 15/16	1 3/16
4	650	0.30	1/2	4 11/16	3 13/16	1 9/16
5	1,000	0.54		5 5/16	4 3/8	
6		0.65		6 11/16	5 5/16	2 1/4
8		1.00		8	7	2 11/16

Note: Reflects changes in rod diameter from previously published data per recent revisions in MSS-SP-58 & 69

PROJECT INFORMATION		APPROVAL STAMP
Project:		<input type="checkbox"/> Approved
Address:		<input type="checkbox"/> Approved as noted
Contractor:		<input type="checkbox"/> Not approved
Engineer:		Remarks:
Submittal Date:		
Notes 1:		
Notes 2:		



Fig. 825 – TOLCO bar joist sway brace attachment

Function: To attach sway bracing and hanger assemblies to steel open web structural members that have a flange thickness of 3/8". Fig. 825 is the structural attachment component of a longitudinal or lateral sway brace assembly. It is intended to be combined with a TOLCO transitional attachment, "bracing pipe" sized in accordance with the transitional attachment instruction sheet and a TOLCO "braced pipe" attachment, to form a complete bracing assembly. Sway brace assemblies are intended to be installed in accordance with NFPA 13 and the manufacturer's installation instructions.

When used with	Maximum UL rated load
Fig. 909	1370 lbs
Fig. 910	1500 lbs
Fig. 980	1600 lbs



Component of State of
California OSHPD Approved
Seismic Restraints System

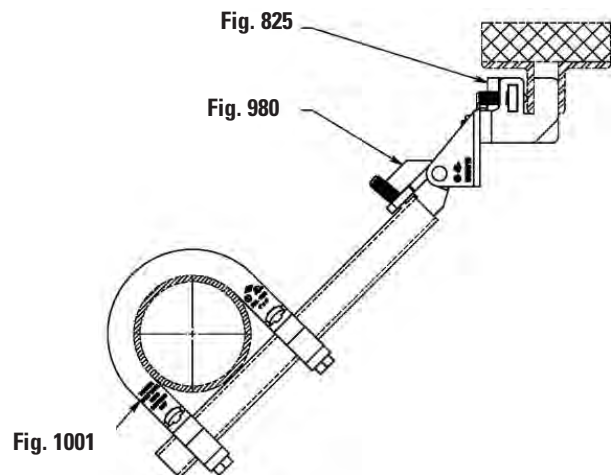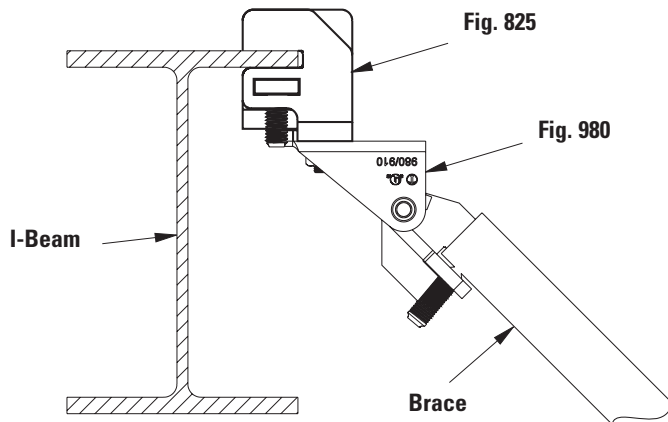

To Install: Place the Fig. 825 on the steel beam, tighten the cone point set screws until heads break off (hint: apply between 31-35 lb. ft. of torque). Attach other TOLCO transitional attachment fitting, Fig. 909, 910, 980 or *986. Transitional fitting attachment can be pivot for adjustment to proper brace angle.

*Not UL listed when used in combination with Fig. 986



Eaton
1000 Eaton Boulevard
Cleveland, OH 44122
United States
Eaton.com
13201 Dahlia Street, Suite 200
Fontana, CA 92337
United States
Phone: 800-851-7415

© 2020 Eaton
All Rights Reserved
Printed in USA
Publication No. IL309017EN
November 2020 B-Line Division

Eaton.com/tolco
Eaton is a registered trademark.

All other trademarks are property
of their respective owners.

Follow us on social media to get the
latest product and support information.



Fig. 980 - Universal Swivel Sway Brace Attachment - 3/8" to 3/4"



Size Range: One size fits bracing pipe 1" (25mm) thru 2" (50mm), B-Line 12 gauge (2.6mm) channel, and all structural steel up to 1/4" (31.7mm) thick.

Material: Steel

Function: Multi-functional attachment to structure or braced pipe fitting.

Features: This product's design incorporates a concentric attachment opening which is critical to the performance of structural seismic connections. NFPA 13 indicates clearly that fastener table load values are based only on concentric loading. Mounts to any surface angle. Break off bolt head assures verification of proper installation.

Installation: Fig.980 is the structural or transitional attachment component of a longitudinal or lateral sway brace assembly. It is intended to be combined with the "bracing pipe" and TOLCO "braced pipe" attachment, Fig. 1000, 1001, 4L, or other TOLCO approved attachment to pipe to form a complete bracing assembly. NFPA 13 guidelines should be followed.

To Install: Place the Fig. 980 onto the "bracing pipe". Tighten the set bolt until the head breaks off. Attachment can pivot for adjustment to proper brace angle.

Approvals: —Approved by Factory Mutual Engineering (FM). For UL Listed information refer to page 66.


Note: Fig. 980 Swivel Attachment and Fig. 1000, 1001, 4L or other TOLCO approved attachment to pipe that make up a sway brace system of UL Listed attachments and bracing materials which satisfies the requirements of Underwriters Laboratories and the National Fire Protection Association (NFPA)

Finish: Plain, Electro-Galvanized or Stainless Steel. Contact B-Line for alternative finishes.



Order By: Figure number and finish.

Pat. #6,273,372, Pat. #6,517,030, Pat. #6,953,174, Pat. #6,708,930, Pat. #7,191,987, Pat. #7,441,730, Pat. #7,669,806

Designed to meet or exceed requirements of FM DS 2-8.



Set Bolt
Included
Mounting Hardware
Is Not Included

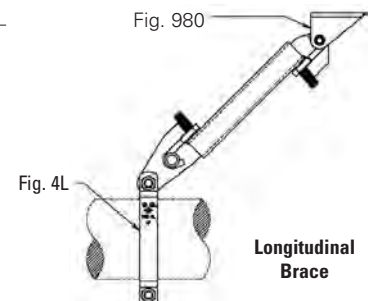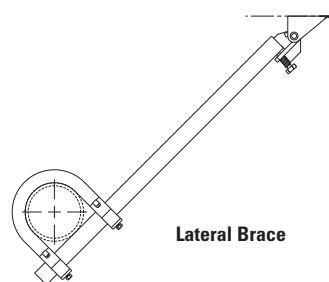

Part Number	Mtg. Hdw. Size in. (mm)	A in. (mm)	B in. (mm)	Mounting Hole D in. (mm)	Max. Design Load** (FM)				Approx. Wt./100 lbs. (kg)
					30° - 44° lbs./(kN)	45° - 59° lbs./(kN)	60° - 74° lbs./(kN)	75° - 90° lbs./(kN)	
980-3/8	3/8" (9.5)	5 1/4" (133.3)	1 7/8" (47.6)	13/32" (10.3)					149 (67.6)
980-1/2 *	1/2" (12.7)	5 1/4" (133.3)	1 7/8" (47.6)	17/32" (13.5)	1320 (5.87)	1970 (8.76)	2310 (10.27)	2550 (11.34)	148 (67.1)
980-5/8	5/8" (15.9)	5 1/4" (133.3)	1 7/8" (47.6)	1 1/16" (17.5)					147 (66.7)
980-3/4	3/4" (19.0)	5 1/4" (133.3)	1 7/8" (47.6)	13/16" (20.5)					146 (66.2)

* Standard size.

** Installed with 1" or 1 1/4" Schedule 40 brace pipe.

FM Approved design loads are based on ASD design method.

Eaton's B-Line Business seismic bracing components are designed to be compatible only with other B-Line bracing components, resulting in a listed seismic bracing assembly. B-Line's warranty for seismic bracing components will be the warranty provided in B-Line's standard terms and conditions of sale made available by B-Line, except that, in addition to the other exclusions from B-Line's warranty, Eaton's B-line Business makes no warranty relating to B-Line's seismic bracing components that are combined with products not provided by Eaton's B-Line Business.

All dimensions in charts and on drawings are in inches. Dimensions shown in parentheses are in millimeters unless otherwise specified.

Fig. 1001 - Sway Brace Attachment



Size Range: Pipe size to be braced: 1" (25mm) thru 8" (200mm) IPS.
Pipe size used for bracing: 1" (25mm) and 1 1/4" (32mm) Schedule 40 IPS.

Material: Steel

Function: For bracing pipe against sway and seismic disturbance.
The pipe attachment component of a sway brace system:
Fig. 1001 is used in conjunction with a Fig. 900 Series fitting and joined together with bracing pipe per NFPA 13, forming a complete sway brace assembly.

Features: Can be used to brace schedules 7 through 40 IPS.
Field adjustable, making critical pre-engineering of bracing pipe length unnecessary. Unique design requires no threading of bracing pipe. Can be used as a component of a four-way riser brace.
Comes assembled and ready for installation. Fig. 1001 has built-in visual verification of correct installation. See installation note below.

Installation Note: Position Fig. 1001 over the pipe to be braced and tighten two hex head cone point set bolts until heads bottom out. A minimum of 1" (25mm) pipe extension is recommended. Brace pipe can be installed on top or bottom of pipe to be braced.


Approvals: Approved by Factory Mutual Engineering (FM).
For UL Listed information refer to page 70.

Finish: Plain or Electro-Galvanized. Contact B-Line for alternative finishes and materials.

Order By: Order by figure number, pipe size to be braced, followed by pipe size used for bracing (1" (25mm) or 1 1/4" (32mm)) , and finish.

Important Note: Fig. 1001 is precision manufactured to perform its function as a critical component of a complete bracing assembly. To ensure performance, the FM Approval requires that Fig. 1001 must be used only with other TOLCO bracing products.

Designed to meet or exceed requirements of FM DS 2-8.

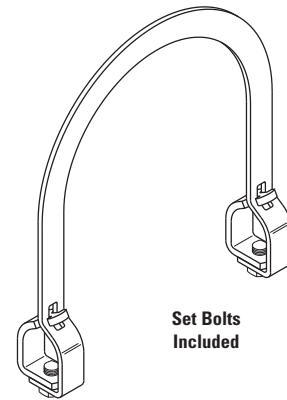

Set Bolts
Included



Pipe Size in. (mm)	Part Number & Approx. Wt./100				Design Load - For Sch. 7, Sch. 10, & Sch. 40 Pipe			
	1" (24mm) Brace Pipe		1 1/4" (32mm) Brace Pipe		Allowable Horizontal Capacity (lbf) Per Installation ^{1,2,3}			
	Lbs. (kg)	Lbs. (kg)	Lbs. (kg)	Lbs. (kg)	30°-44° Lbs. (kN)	45°-59° Lbs. (kN)	60°-74° Lbs. (kN)	75°-90° Lbs. (kN)
1" (25)	1001-1 X 1	100.0 (45.3)	1001-1 X 1 1/4	118.0 (53.5)	1800 (8.00)	2550 (11.34)	3120 (13.88)	3490 (25.52)
1 1/4" (32)	1001-1 1/4 X 1	100.0 (45.3)	1001-1 1/4 X 1 1/4	114.0 (51.7)	1230 (5.47)	1740 (7.74)	2140 (9.52)	2380 (10.58)
1 1/2" (40)	1001-1 1/2 X 1	100.0 (45.3)	1001-1 1/2 X 1 1/4	115.0 (52.1)	1230 (5.47)	1740 (7.74)	2140 (9.52)	2380 (10.58)
2" (50)	1001-2 X 1	108.0 (49.0)	1001-2 X 1 1/4	121.0 (54.9)	1230 (5.47)	1740 (7.74)	2140 (9.52)	2380 (10.58)
2 1/2" (65)	1001-2 1/2 X 1	138.6 (62.8)	1001-2 1/2 X 1 1/4	160.4 (72.7)	800 (3.56)	1130 (5.02)	1380 (6.14)	1540 (6.85)
3" (80)	1001-3 X 1	147.2 (66.7)	1001-3 X 1 1/4	168.7 (76.5)	850 (3.78)	1200 (5.34)	1470 (6.54)	1640 (7.29)
4" (100)	1001-4 X 1	160.9 (73.0)	1001-4 X 1 1/4	182.4 (82.7)	850 (3.78)	1200 (5.34)	1470 (6.54)	1640 (7.29)
6" (150)	1001-6 X 1	190.0 (86.2)	1001-6 X 1 1/4	211.4 (95.9)	510 (2.27)	730 (3.25)	890 (3.96)	990 (4.40)
8" (200)	1001-8 X 1	217.4 (98.6)	1001-8 X 1 1/4	238.8 (108.3)	510 (2.27)	730 (3.25)	890 (3.96)	990 (4.40)

¹ FM Approved when used with 1 or 1 1/4 inch NPS Schedule 40 GB/T 3091, EN 10255H, or JIS G3451 steel pipe as the brace member.

² Load rating for LW above refers to FM Approved Lightwall Pipe commonly referred to as "Schedule 7". These ratings may also be applied when EN 10220 and GB/T 8163 steel pipe.

³ Load rating for Schedule 10 above may be applied to GB/T 3092, EN 10255M and H, or JIS G3454, FM Approved Thinwall, or Schedule 40 steel pipes.

Note: See UL load ratings in UL Listed Design Load chart shown under drawing.



All dimensions in charts and on drawings are in inches. Dimensions shown in parentheses are in millimeters unless otherwise specified.

SECTION 3

FIRE SPRINKLERS

Series RFI — 5.6 K-factor “Royal Flush II” Pendent Concealed Sprinklers Quick & Standard Response, Standard Coverage

General Description

The Tyco® Series RFI Quick Response (3 mm bulb) & Standard Response (5 mm bulb), 5.6 K-Factor, “Royal Flush II” Concealed Pendent Sprinklers are decorative sprinklers featuring a flat cover plate designed to conceal the sprinkler. It is the best choice for architecturally sensitive areas such as hotel lobbies, office buildings, churches, and restaurants.

Each unit includes a Cover Plate Assembly that conceals the sprinkler operating components above the ceiling. The separable two-piece design of the Cover Plate and Support Cup Assemblies allows installation of the sprinklers and pressure testing of the fire protection system prior to installation of a suspended ceiling or application of the finish coating to a fixed ceiling. They also permit removal of suspended ceiling panels for access to building service equipment without having to first shut down the fire protection system and remove sprinklers.

Also, the separable two-piece design of the Sprinkler provides for 1/2 inch (12,7 mm) of vertical adjustment, to provide a measure of flexibility with regard to which the length of fixed pipe drops to the sprinklers must be cut.

The Series RFI Sprinklers are shipped with a Disposable Protective Cap. The

Protective Cap is temporarily removed for installation, and then it can be replaced to help protect the sprinkler while the ceiling is being installed or finished. The tip of the Protective Cap can also be used to mark the center of the ceiling hole into plaster board, ceiling tiles, etc. by gently pushing the ceiling product against the Protective Cap. When the ceiling installation is complete the Protective Cap is removed and the Cover Plate Assembly installed.

As an option, the Series RFI Standard Response (5 mm bulb) “Royal Flush II” Concealed Pendent Sprinklers may be fitted with a silicone Air and Dust Seal (Ref. Fig. 5). The Air and Dust Seal is intended for sensitive areas where it is desirable to stop air and dust travel through the cover plate from the area above the ceiling.

NOTICE

The Series RFI Concealed Pendent Sprinklers described herein must be installed and maintained in compliance with this document and with the applicable standards of the National Fire Protection Association, in addition to the standards of any authorities having jurisdiction. Failure to do so may impair the performance of these devices.

The owner is responsible for maintaining their fire protection system and devices in proper operating condition. The installing contractor or sprinkler manufacturer should be contacted with any questions.

Model/Sprinkler Identification Number

TY3551 (5 mm bulb)

TY3531 (3 mm bulb)



Technical Data

Approvals:

UL and C-UL Listed. FM Approved NYC under MEA 353-01-E. LPCB (Ref. No. 094a/09 for TY3551 & 094a/10 for TY3531)

The approvals apply only to the service conditions indicated in the Design Criteria section.

Approvals for Air & Dust Seal: (Part # 10908100)

UL and C-UL Listed for use with the RFI (TY3551); Standard Response Concealed Sprinkler.

Maximum Working Pressure:

Maximum 250 psi (17,3 bar) by UL, C-UL, and NYC. Maximum 175 psi (12,1 bar) by FM and LPCB.

Temperature Rating:

155°F/68°C - Sprinkler
139°F/59°C - Plate
200°F/93°C - Sprinkler
165°F/74°C - Plate

Discharge Coefficient:

K= 5.6 GPM/psi^{1/2} (80,6 LPM/bar^{1/2})

Adjustment:


1/2 inch (12,7 mm)

Finishes:

Refer to Ordering Procedure section.

IMPORTANT

Always refer to Technical Data Sheet TFP700 for the “INSTALLER WARNING” that provides cautions with respect to handling and installation of sprinkler systems and components. Improper handling and installation can permanently damage a sprinkler system or its components and cause the sprinkler to fail to operate in a fire situation or cause it to operate prematurely.

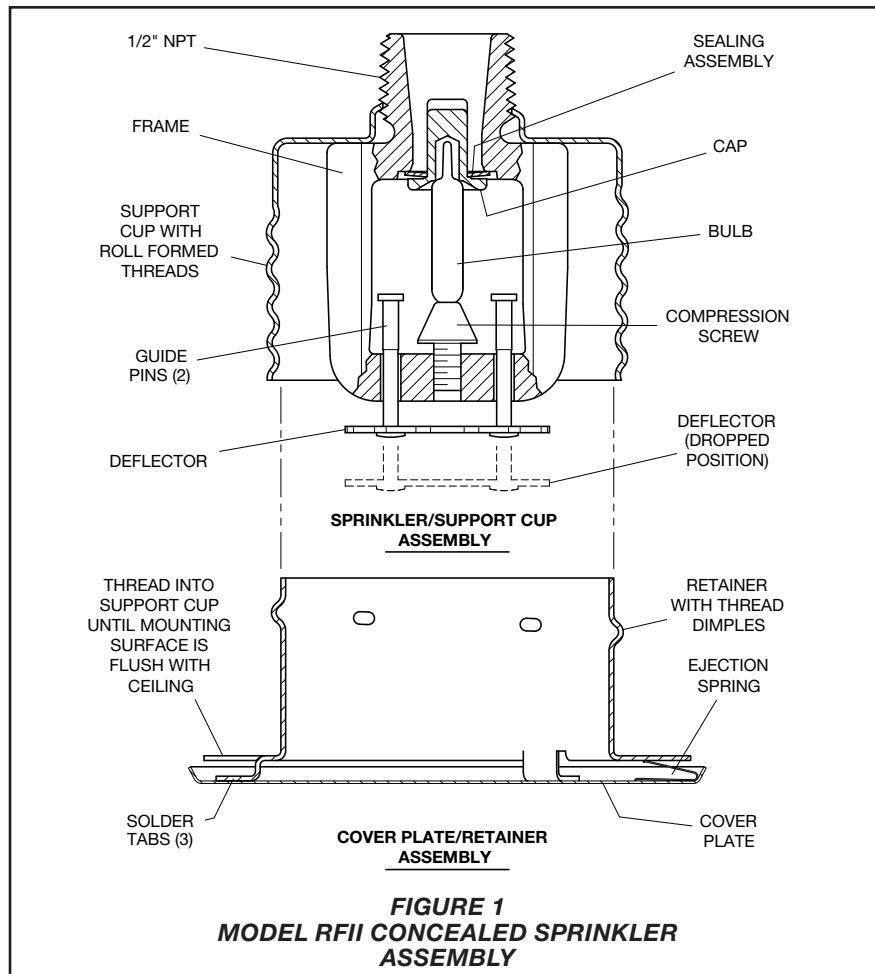**Physical Characteristics:**

Frame Bronze
 Support Cup Chrome Plated Steel
 Guide Pins Stainless Steel
 Deflector Bronze
 Compression Screw Brass
 Bulb Glass
 Cap Bronze or Copper
 Sealing Assembly Beryllium Nickel w/ Teflon†
 Cover Plate Brass
 Retainer Brass
 Ejection Spring Stainless Steel

†DuPont Registered Trademark

Patents:

U.S.A. Patent No. 4,014,388

Operation

When exposed to heat from a fire, the Cover Plate, normally soldered to the Retainer at three points, falls away to expose the Sprinkler Assembly. At this point the Deflector supported by the Guide Pins drops down to its operational position.

The glass Bulb contains a fluid that expands when exposed to heat. When the rated temperature is reached, the fluid expands sufficiently to shatter the

glass Bulb, activating the sprinkler and allowing water to flow.

Design Criteria

The RFII (TY3551), 5 mm Bulb Type, Concealed Pendent Sprinklers are UL and C-UL Listed as standard response -standard spray sprinklers for use in accordance with the current NFPA standard. They are FM Approved as standard response -standard spray sprinklers for use in accordance with the current FM Loss Prevention Data Sheets.

The RFII (TY3531) 3 mm Bulb Type, Concealed Pendent Sprinklers are UL and C-UL Listed as quick response standard spray sprinklers for use in accordance with the current NFPA standard. They are FM Approved as standard response -standard spray sprinklers for use in accordance with the current FM Loss Prevention Data Sheets.

The Series RFII Concealed Pendent Sprinklers are only listed and approved with the Series RFII Concealed Cover

Plates having a factory applied finish.

The Series RFII must not be used in applications where the air pressure above the ceiling is greater than that below. Down drafts through the Support Cup could delay sprinkler operation in a fire situation.

Installation

The Tyco® Series RFII must be installed in accordance with the following instructions:

NOTICE

Do not install any bulb type sprinkler if the bulb is cracked or there is a loss of liquid from the bulb. With the sprinkler held horizontally, a small air bubble should be present. The diameter of the air bubble is approximately 1/16 inch (1,6 mm) for the 155°F/68°C and 3/32 inch (2,4 mm) for the 200°F/93°C temperature ratings.

A 1/2 inch NPT sprinkler joint should be obtained with a minimum to maximum torque of 7 to 14 ft.lbs. (9,5 to 19,0 Nm). Higher levels of torque may distort the sprinkler inlet with consequent leakage or impairment of the sprinkler.

Do not attempt to compensate for insufficient adjustment in the Sprinkler Assembly by under-or over-tightening the Sprinkler/Support Cup Assembly. Readjust the position of the sprinkler fitting to suit.

Step 1. The sprinkler must only be installed in the pendent position and with the centerline of the sprinkler perpendicular to the mounting surface.

Step 2. Remove the Protective Cap.



Step 3. With pipe thread sealant applied to the pipe threads, hand tighten the sprinkler into the sprinkler fitting.

Step 4. Wrench tighten the sprinkler using only the RFII Sprinkler Wrench (Ref. Figure 3). The RFII Sprinkler Wrench is to be applied to the Sprinkler as shown in Figure 3.

Step 5. Replace the Protective Cap (Ref. Figure 4) by pushing it upwards until it bottoms out against the Support Cup. The Protective Cap helps prevent damage to the Deflector and Arms during ceiling installation and/or during application of the finish coating of the ceiling. It may also be used to locate the center of the clearance hole by gently pushing the ceiling material up against the center point of the Protective Cap.

NOTICE

As long as the Protective Cap remains in place, the system is considered to be "Out of Service".

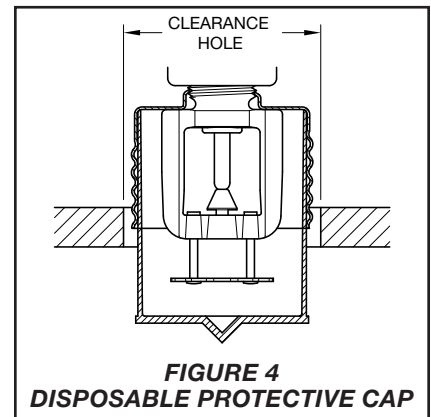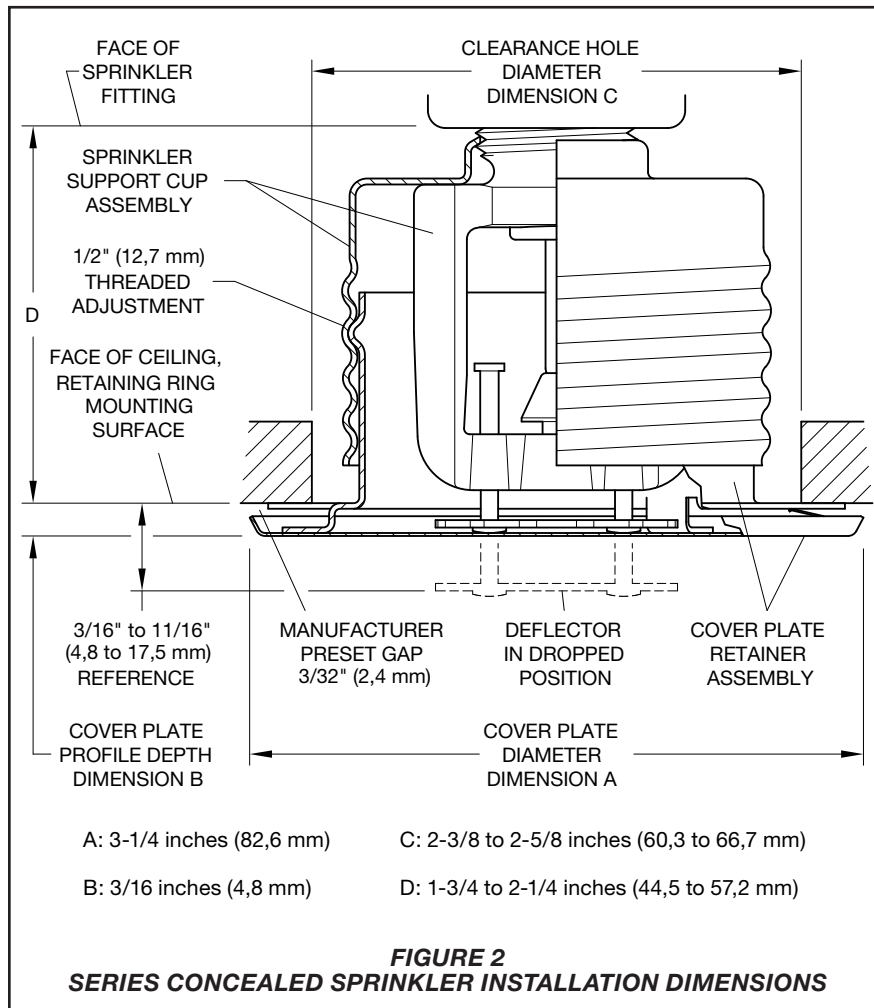

Step 6. After the ceiling has been completed with the 2-1/2 inch (63,5 mm) diameter clearance hole and in preparation for installing the Cover Plate Assembly, remove and discard the Protective Cap, and verify that the Deflector moves up and down freely. If the Sprinkler has been damaged and the Deflector does not move up and down freely, replace the entire Sprinkler assembly. Do not attempt to modify or repair a damaged sprinkler.

Step 7. When installing an Air and Dust Seal, refer to Figure 5, otherwise proceed to Step 8. To attach the Air and Dust Seal, verify the angle of the outside edge of the seal is oriented according to Figure 5. Start the edge of the Retainer in the grooved slot of the Air and Dust Seal and continue around the retainer until the entire Air and Dust Seal is engaged.

Step 8. Screw on the Cover Plate/Retainer Assembly until the Retainer Figure 2 (or Air and Dust Seal -Figure 5) contacts with the ceiling. Do not continue to screw on the Cover Plate/Retainer Assembly such that it lifts a ceiling panel out of its normal position. If the Cover Plate/Retainer Assembly cannot be engaged with the Support Cup or the Cover Plate/Retainer Assembly cannot be engaged sufficiently to contact the ceiling, the Sprinkler Fitting must be repositioned.


Care and Maintenance

The Tyco® Series RFI must be maintained and serviced in accordance with the following instructions:

NOTICE

Absence of the Cover Plate Assembly may delay sprinkler operation in a fire situation.

When properly installed, there is a nominal 3/32 inch (2,4 mm) air gap between the lip of the Cover Plate and the ceiling,

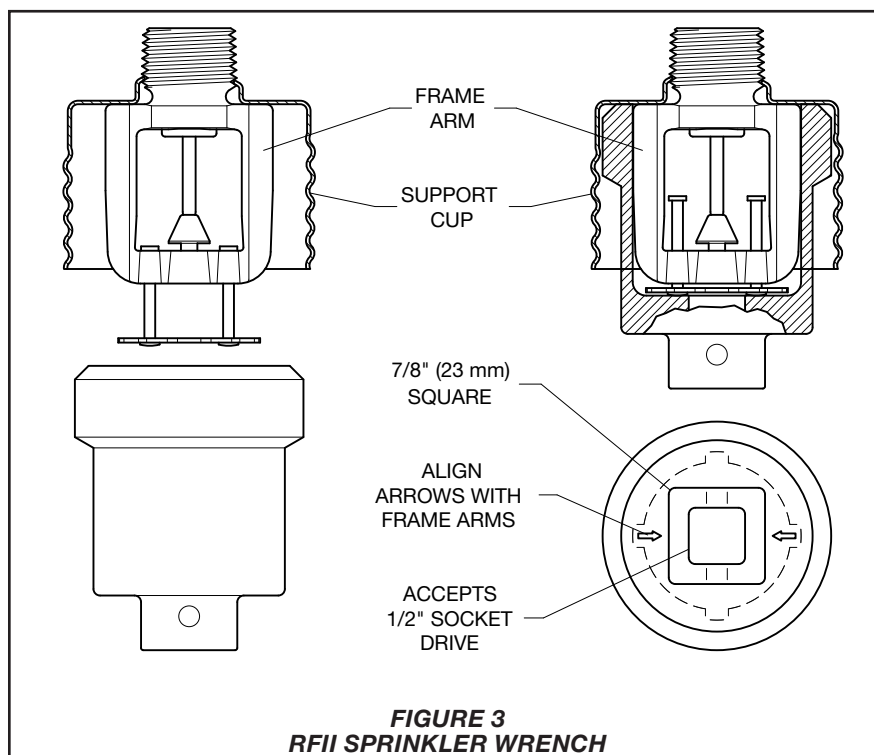

as shown in Figure 2. This air gap is necessary for proper operation of the sprinkler. If the ceiling is to be repainted after the installation of the Sprinkler, care must be exercised to ensure that the new paint does NOT seal off any of the air gap.

Factory painted Cover Plates **MUST NOT** be repainted. They should be replaced, if necessary, by factory painted units. Non-factory applied paint may adversely delay or prevent sprinkler operation in the event of a fire.

Do not pull the Cover Plate relative to the Enclosure. Separation may result.

Before closing a fire protection system main control valve for maintenance work on the fire protection system that it controls, permission to shut down the affected fire protection system must be obtained from the proper authorities and all personnel who may be affected by this action must be notified.

Sprinklers that are found to be leaking or exhibiting visible signs of corrosion must be replaced.

Automatic sprinklers must never be painted, plated, coated or otherwise altered after leaving the factory. Modified or over heated sprinklers must be replaced.

Care must be exercised to avoid damage to the sprinklers -before, during, and after installation. Sprinklers damaged by dropping, striking, wrench twist/slippage, or the like, must be replaced. Also, replace any sprinkler that has a cracked bulb or that has lost liquid from its bulb. (Ref. Installation Section).

If a sprinkler must be removed, do not reinstall it or a replacement without reinstalling the Cover Plate Assembly. If a Cover Plate Assembly becomes dislodged during service, replace it immediately.

The owner is responsible for the inspection, testing, and maintenance of their fire protection system and devices in compliance with this document, as well as with the applicable standards of the National Fire Protection Association (e.g., NFPA 25), in addition to the standards of any other authorities having jurisdiction. The installing contractor or sprinkler manufacturer should be contacted relative to any questions.

Automatic sprinkler systems should be inspected, tested, and maintained by a qualified Inspection Service in accordance with local requirements and/or national code.

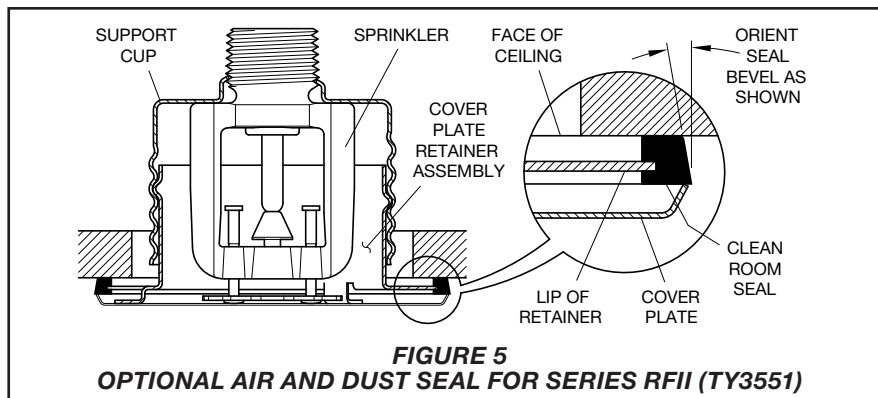


FIGURE 5
OPTIONAL AIR AND DUST SEAL FOR SERIES RFII (TY3551)

Limited Warranty

Products manufactured by Tyco Fire & Building Products (TFBP) are warranted solely to the original Buyer for ten (10) years against defects in material and workmanship when paid for and properly installed and maintained under normal use and service. This warranty will expire ten (10) years from date of shipment by TFBP. No warranty is given for products or components manufactured by companies not affiliated by ownership with TFBP or for products and components which have been subject to misuse, improper installation, corrosion, or which have not been installed, maintained, modified or repaired in accordance with applicable Standards of the National Fire Protection Association, and/or the standards of any other Authorities Having Jurisdiction. Materials found by TFBP to be defective shall be either repaired or replaced, at TFBP's sole option. TFBP neither assumes, nor authorizes any person to assume for it, any other obligation in connection with the sale of products or parts of products. TFBP shall not be responsible for sprinkler system design errors or inaccurate or incomplete information supplied by Buyer or Buyer's representatives.

In no event shall TFBP be liable, in contract, tort, strict liability or under any other legal theory, for incidental, indirect, special or consequential damages, including but not limited to labor charges, regardless of whether TFBP was informed about the possibility of such damages, and in no event shall TFBP's liability exceed an amount equal to the sales price.

The foregoing warranty is made in lieu of any and all other warranties, express or implied, including warranties of merchantability and fitness for a particular purpose.

This limited warranty sets forth the exclusive remedy for claims based on failure of or defect in products, materi-

als or components, whether the claim is made in contract, tort, strict liability or any other legal theory.

This warranty will apply to the full extent permitted by law. The invalidity, in whole or part, of any portion of this warranty will not affect the remainder.

Ordering Procedure

When placing an order, indicate the full product name. Contact your local distributor for availability.

Sprinkler Assembly

Specify: (SIN), (specify temperature rating) Series RFII Concealed Pendent Sprinkler, P/N (specify).

	155°F/68°C	200°F/93°C
TY3551	51-790-1-155	51-790-1-200
TY3531	51-792-1-155	51-792-1-200

Separately Ordered Cover Plate:

Specify: (specify temperature rating) Series RFII Concealed Cover Plate with (specify finish), P/N (specify).

	139°F/59°C(a)	165°F/74°C(b)
Brass.....	56-792-1-135	56-792-1-165
Chrome.....	56-792-9-135	56-792-9-165
Signal White (c) (RAL 9003)....	56-792-4-135	56-792-4-165
Grey White (d) (RAL 9002)....	56-792-0-135	56-792-0-165
Pure White (e) (RAL 9010)....	56-792-3-135	56-792-3-165
Custom.....	56-792-X-135	56-792-X-165

- (a) For use with 155°F/68°C sprinklers.
- (b) For use with 200°F/93°C sprinklers.
- (c) Previously known as Bright White.
- (d) Previously known as Standard White.
- (e) Eastern Hemisphere sales only.

Sprinkler Wrench:

Specify: RFII Sprinkler Wrench, P/N 56-000-1-075.

Air and Dust Seal:

Specify: Air and Dust Seal, P/N 56-908-1-001.



Worldwide
Contacts

www.tyco-fire.com

Series TY-B – 2.8, 5.6, and 8.0 K-factor Upright, Pendent, and Recessed Pendent Sprinklers Standard Response, Standard Coverage

General Description

The TYCO Series TY-B 2.8, 5.6, and 8.0 K-factor, Upright, Pendent, and Recessed Pendent Sprinklers described in herein are standard response, standard coverage, decorative 5 mm glass bulb-type spray sprinklers. They are designed for use in light, ordinary, or extra-hazard commercial occupancies such as banks, hotels, shopping malls, factories, refineries, and chemical plants.

The TY-B Recessed Pendent Sprinkler, where applicable, is intended for use in areas with a finished ceiling. It uses a two-piece Style 10 (1/2 in. NPT) or Style 40 (3/4 in. NPT) Recessed Escutcheon. The Recessed Escutcheon provides 1/2 in. (12,7 mm) of recessed adjustment or up to 3/4 in. (19,1 mm) of total adjustment from the flush pendent position. The adjustment provided by the Recessed Escutcheon reduces the accuracy to which the fixed pipe drops to the sprinklers must be cut.

Corrosion-resistant coatings, where applicable, are utilized to extend the life of copper alloy sprinklers beyond what would be obtained when exposed to corrosive atmospheres. Although corrosion-resistant coated sprinklers have passed the standard corrosion tests of the applicable approval agencies, the testing is not representative of all possible corrosive atmospheres. Consequently,

it is recommended that the end-user be consulted about the suitability of these coatings for any given corrosive environment. The effects of ambient temperature, concentration of chemicals, and gas/chemical velocity, should be considered as a minimum, along with the corrosive nature of the chemical to which the sprinklers will be exposed.

An intermediate level version of the Series TY-B Pendent Sprinkler can be obtained by utilizing the Series TY-B Pendent Sprinkler in combination with the Model S2 Shield.

NOTICE


The Series TY-B 2.8, 5.6, and 8.0 K-factor, Upright, Pendent, and Recessed Pendent Sprinklers described herein must be installed and maintained in compliance with this document, as well as with the applicable standards of the National Fire Protection Association (NFPA), in addition to the standards of any other authorities having jurisdiction. Failure to do so may impair the performance of these devices.

The owner is responsible for maintaining their fire protection system and devices in proper operating condition. Contract the installing contractor or product manufacturer with any questions.

NFPA 13 prohibits installation of 1/2 in. NPT sprinklers with K-factors greater than 5.6 in new construction. They are intended for retrofit in existing sprinkler systems only.

Sprinkler Identification Numbers (SIN)

TY1151 . . . Upright 2.8K, 1/2 in. NPT
TY1251 . . . Pendent 2.8K, 1/2 in. NPT
TY3151 . . . Upright 5.6K, 1/2 in. NPT
TY3251 . . . Pendent 5.6K, 1/2 in. NPT
TY4151 . . . Upright 8.0K, 3/4 in. NPT
TY4251 . . . Pendent 8.0K, 3/4 in. NPT
TY4851 . . . Upright 8.0K, 1/2 in. NPT
TY4951 . . . Pendent 8.0K, 1/2 in. NPT

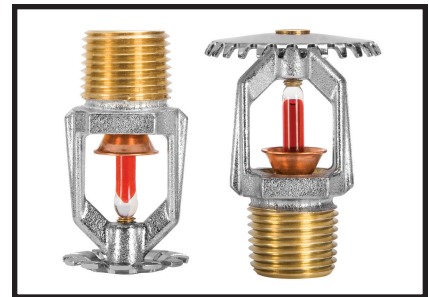

Technical Data

Approvals

UL and C-UL Listed
FM, LPCB, VdS, and NYC Approved

Refer to Table A for complete approval information, including corrosion-resistant status.

Maximum Working Pressure

Refer to Table B

Discharge Coefficient

K=2.8 GPM/psi^{1/2} (40,3 LPM/bar^{1/2})
K=5.6 GPM/psi^{1/2} (80,6 LPM/bar^{1/2})
K=8.0 GPM/psi^{1/2} (115,2 LPM/bar^{1/2})

Temperature Ratings

Refer to Table A

Finishes

Sprinkler: Refer to Table C

Recessed Escutcheon: Signal or Pure White, Grey Aluminum, Jet Black, Chrome Plated, or Natural Brass



Physical Characteristics



Frame Bronze
Button Brass/Copper
Sealing Assembly . . Beryllium Nickel w/TEFLON
Bulb Glass
Compression Screw Bronze
Deflector Copper
Bushing (K=2.8) Bronze





IMPORTANT

Refer to Technical Data Sheet TFP2300 for warnings pertaining to regulatory and health information.

Always refer to Technical Data Sheet TFP700 for the "INSTALLER WARNING" that provides cautions with respect to handling and installation of sprinkler systems and components. Improper handling and installation can permanently damage a sprinkler system or its components and cause the sprinkler to fail to operate in a fire situation or cause it to operate prematurely.

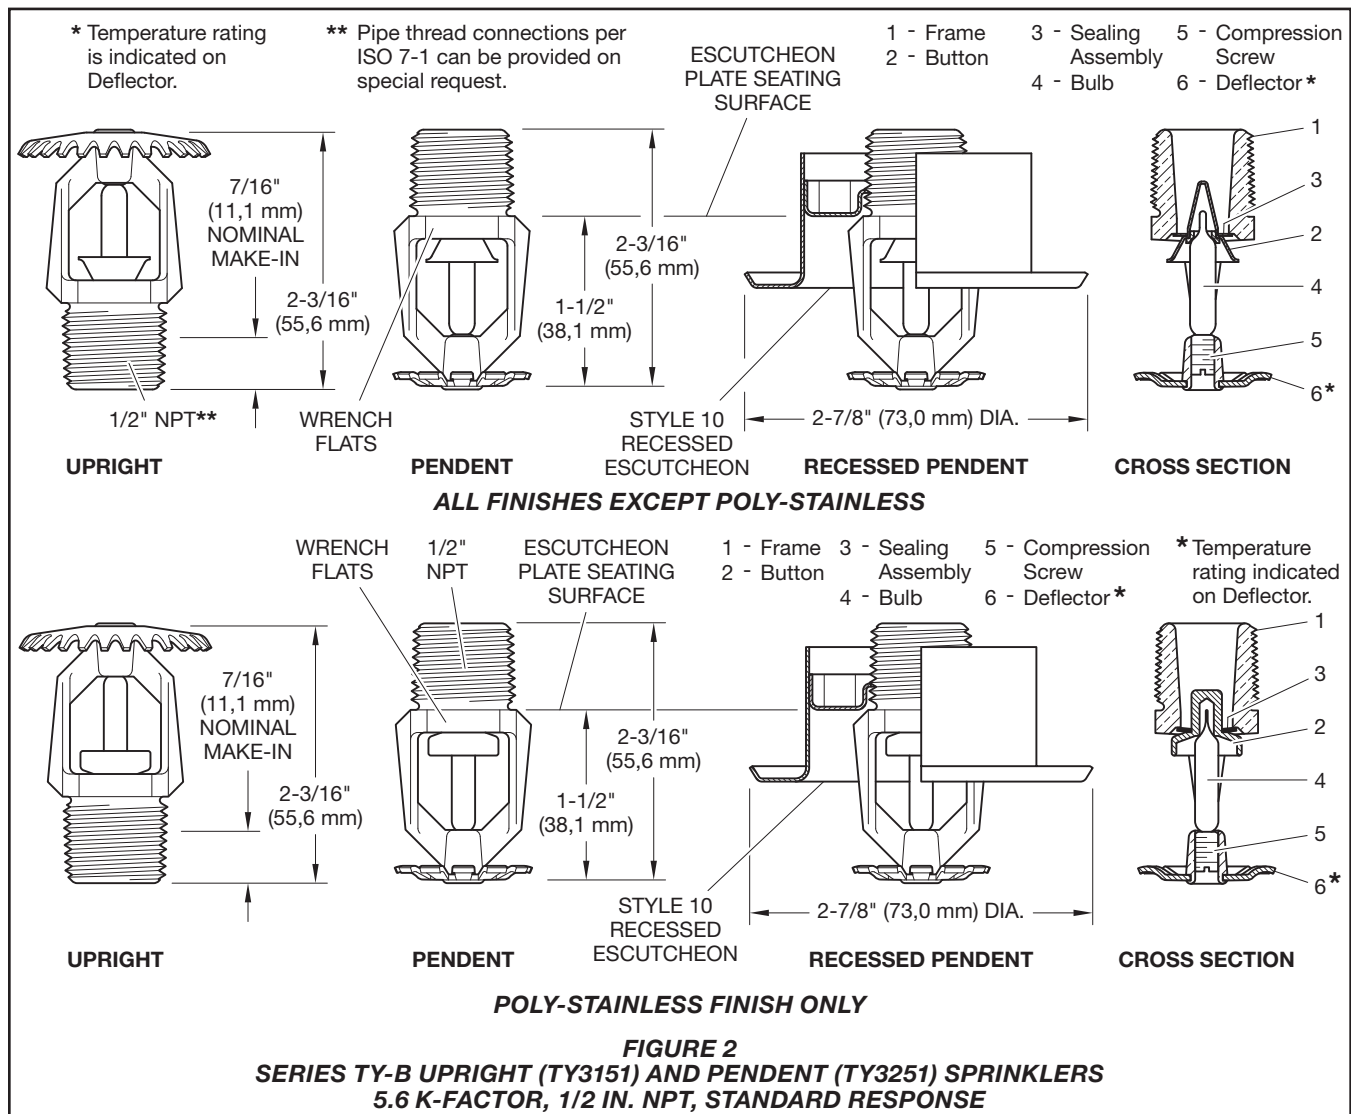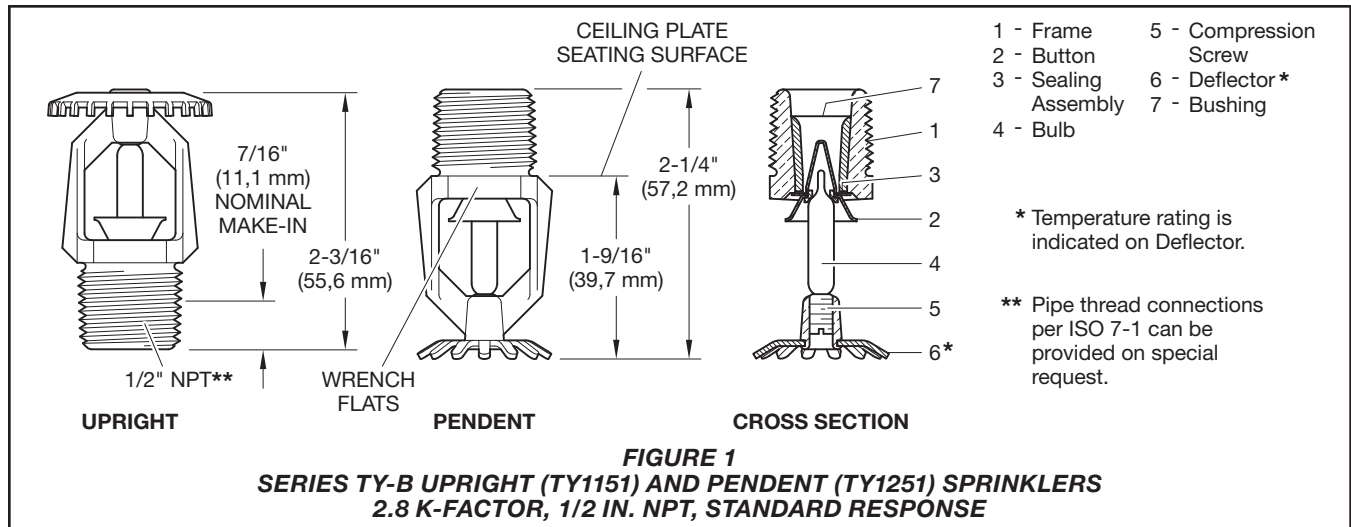

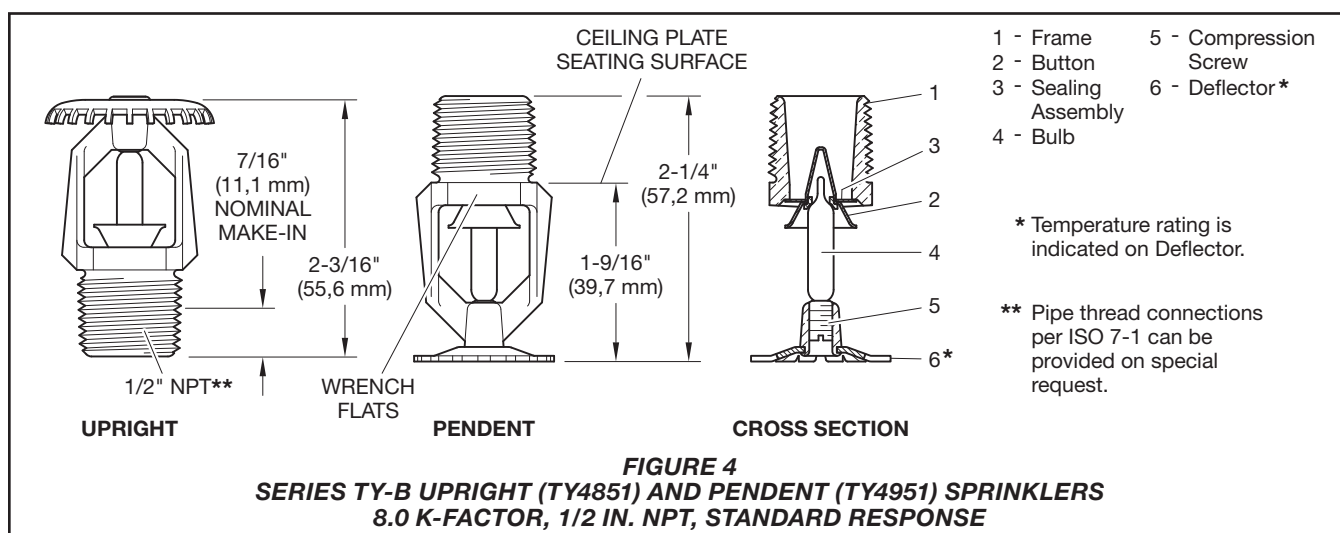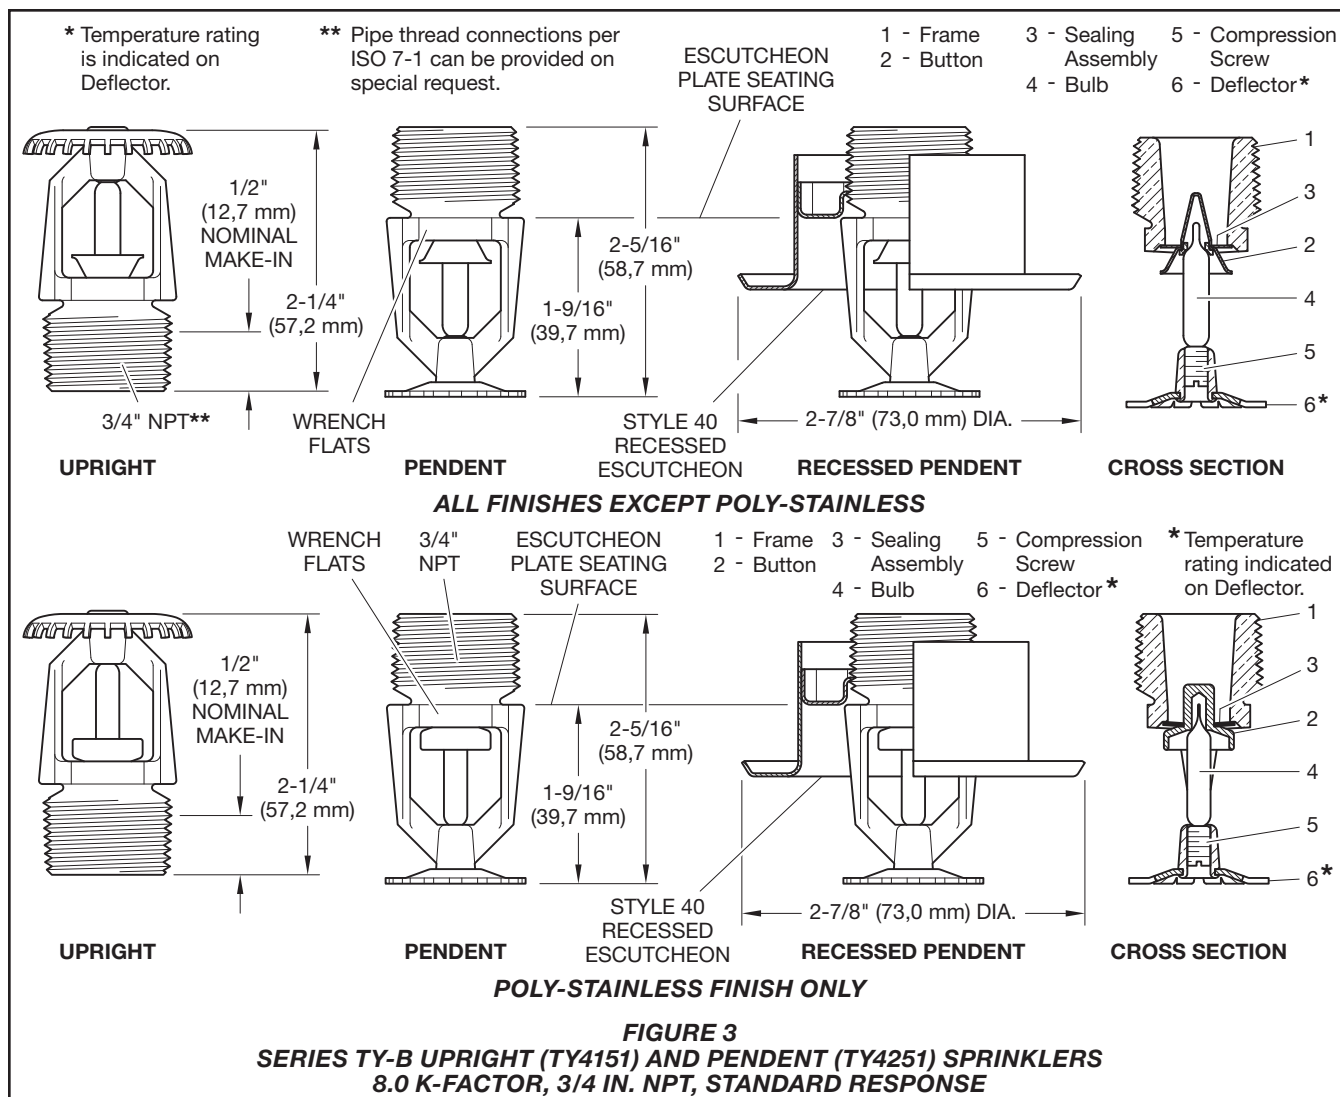

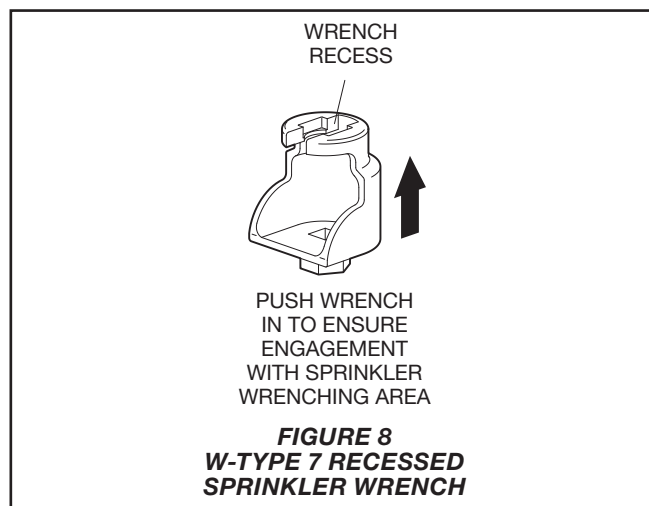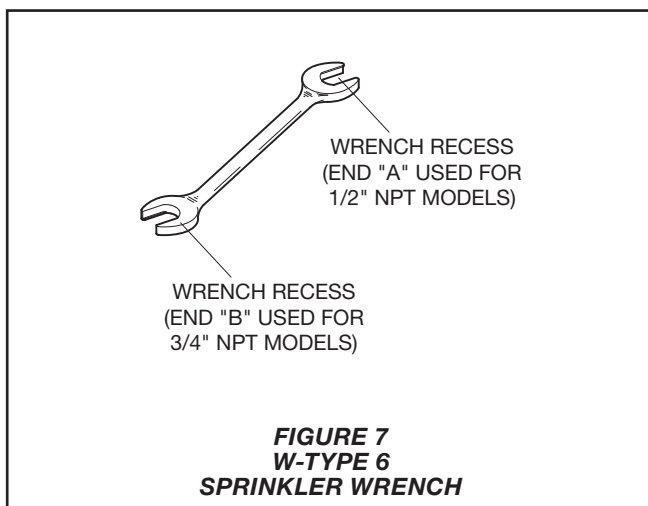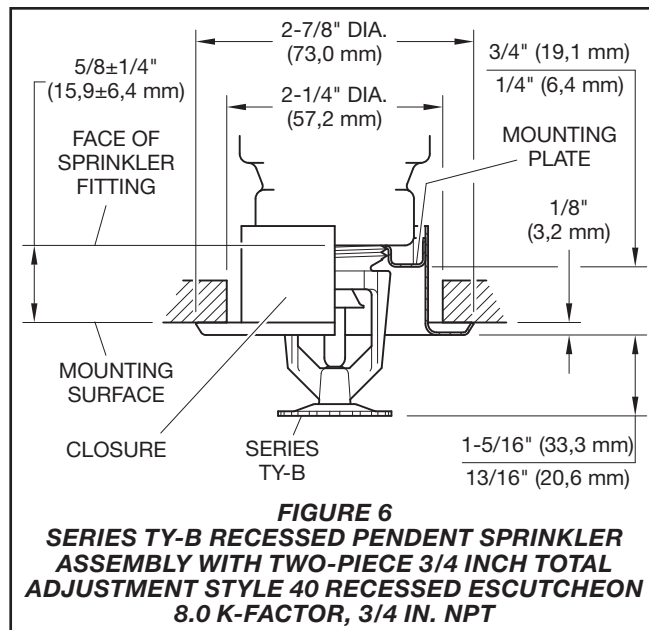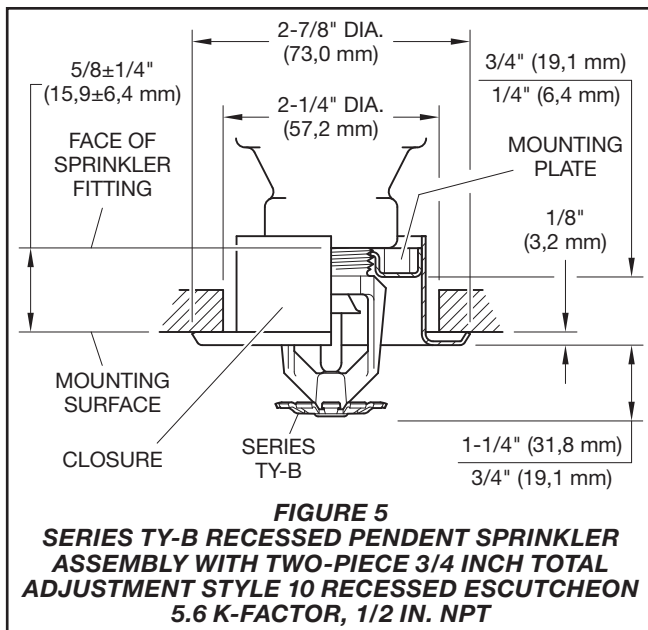

Poly-Stainless Physical Characteristics

Frame	Bronze
Button	L316 Stainless Steel*
Bulb	Glass
Compression Screw	L316 Stainless Steel*
Deflector	Copper/Bronze
Sealing Assembly	Gold Plated Beryllium Nickel w/TEFLON

*Type L316 stainless steel (UNS 31603) per ASTM A479/479M or BS EN 1008 WN1.4404.

Operation

The glass bulb contains a fluid which expands when exposed to heat. When the rated temperature is reached, the fluid expands sufficiently to shatter the glass bulb, allowing the sprinkler to activate and water to flow.

Design Criteria

The TYCO Series TY-B 2.8, 5.6, and 8.0 K-factor, Upright, Pendent, and Recessed Pendent Sprinklers are intended for fire protection systems designed in accordance with the standard installation rules recognized by the applicable Listing or Approval agency, such as UL Listing based on the requirements of NFPA 13 and FM Approval based on the requirements of the FM Global Loss Prevention Data Sheets. Use only the Style 10 or 40 Recessed Escutcheon, as applicable, for recessed pendent installations.

Installation

The TYCO Series TY-B 2.8, 5.6, and 8.0 K-factor, Upright, Pendent, and Recessed Pendent Sprinklers must be installed in accordance with this section.

General Instructions

Do not install any bulb type sprinkler if the bulb is cracked or there is a loss of liquid from the bulb. With the sprinkler held horizontally, a small air bubble should be present. The diameter of the air bubble is approximately 1/16 in. (1,6 mm) for the 135°F (57°C) to 3/32 in. (2,4 mm) for the 360°F (182°C) temperature ratings.

A leak-tight 1/2 in. NPT sprinkler joint should be obtained by applying a minimum-to-maximum torque of 7 to 14 lb-ft (9,5 to 19,0 N·m). Obtain a leak-tight 3/4 in. NPT sprinkler joint by applying a minimum to maximum

K	Sprinkler Type	Temperature Rating	Bulb Liquid Color	Sprinkler Finish ⁸						
				Natural Brass	Chrome Plated	Polyester ^c	Poly-Stainless ^c	Lead Coated	Wax Coated	Wax-Over-Lead Coated
2.8 1/2 in. NPT	Upright (TY1151) and Pendent (TY1251) Figure 1	135°F (57°C)	Orange	1, 2, 3			N/A	N/A ^d		
		155°F (68°C)	Red							
		175°F (79°C)	Yellow							
		200°F (93°C)	Green							
		286°F (141°C)	Blue							
		360°F (182°C)	Mauve	1, 2						
5.6 1/2 in. NPT	Upright (TY3151) and Pendent (TY3251) Figure 2	135°F (57°C)	Orange	1, 2, 3, 4, 5, 6, 7			1, 2	1, 2, 3, 5	1, 2, 3, 5	1, 2, 3, 5
		155°F (68°C)	Red						1 ^b , 2 ^b , 3 ^b , 5 ^b	1 ^b , 2 ^b , 3 ^b , 5 ^b
		175°F (79°C)	Yellow							
		200°F (93°C)	Green							
		286°F (141°C)	Blue							
		360°F (182°C)	Mauve						N/A	
	Recessed Pendent (TY3251) ^a Figure 5	135°F (57°C)	Orange	1, 2, 3, 4, 5			1, 2	N/A		
		155°F (68°C)	Red							
		175°F (79°C)	Yellow							
		200°F (93°C)	Green							
		286°F (141°C)	Blue	1, 2						
	8.0 3/4 in. NPT	Upright (TY4151) and Pendent (TY4251) Figure 3	135°F (57°C)	Orange	1, 2, 3, 4, 5, 6, 7			1, 2	1, 2, 5	1, 2, 3, 5
155°F (68°C)			Red	1 ^b , 2 ^b , 3 ^b , 5 ^b						1 ^b , 2 ^b , 5 ^b
175°F (79°C)			Yellow							
200°F (93°C)			Green							
286°F (141°C)			Blue							
360°F (182°C)			Mauve	N/A						
Recessed Pendent (TY4251) ^a Figure 6		135°F (57°C)	Orange	1, 2, 3, 4, 5			1, 2	N/A		
		155°F (68°C)	Red							
		175°F (79°C)	Yellow							
		200°F (93°C)	Green							
		286°F (141°C)	Blue	1, 2						
8.0 1/2 in. NPT		Upright (TY4851) and Pendent (TY4951) Figure 4	135°F (57°C)	Orange	1, 2, 3, 4, 5, 6			N/A	N/A	
	155°F (68°C)		Red							
	175°F (79°C)		Yellow							
	200°F (93°C)		Green							
	286°F (141°C)		Blue							
	360°F (182°C)		Mauve							

NOTES

- Listed by Underwriters Laboratories, Inc. (UL).
- Listed by Underwriters Laboratories, Inc. for use in Canada (C-UL).
- Approved by FM Global (FM Approvals).
- Approved by the Loss Prevention Certification Board (LPCB Ref. No. 007k/03).
- Approved by the City of New York under MEA 354-01-E.
- VdS Approved. (For details, contact Johnson Controls, Enschede, Netherlands, Tel. 31-53-428-4444 / Fax 31-53-428-3377)
- Approved by the Loss Prevention Certification Board (LPCB Ref. No. 094a/05)
- Where Polyester Coated, Lead Coated, Wax Coated, and Wax-over-Lead Coated Sprinklers are noted to be UL and C-UL Listed, the sprinklers are UL and C-UL Listed as Corrosion-Resistant Sprinklers. Where Lead Coated, Wax Coated, and Wax-over-Lead Coated Sprinklers are noted to be FM Approved, the sprinklers are FM Approved as Corrosion-Resistant Sprinklers.
- Installed with Style 10 (1/2 in. NPT) or Style 40 (3/4 in. NPT) 3/4 in. Total Adjustment Recessed Escutcheon, as applicable
- 150°F (66°C) maximum ceiling temperature
- Frame and deflector only
- Not Applicable (N/A)

TABLE A
SERIES TY-B UPRIGHT AND PENDENT SPRINKLERS
LABORATORY LISTINGS AND APPROVALS

K	Type	Sprinkler Finish					
		Natural Brass	Chrome Plated	Polyester ¹	Lead Coated	Wax Coated	Wax-Over-Lead Coated
2.8 1/2 in. NPT	Upright (TY1151) and Pendent (TY1251)	175 psi (12,1 bar)			N/A ³		
5.6 1/2 in. NPT	Upright (TY3151) and Pendent (TY3251)	250 psi (17,2 bar) ² or 175 psi (12,1 bar)					
	Recessed Pendent (TY3251)						
8.0 3/4 in. NPT	Upright (TY4151) and Pendent (TY4251)	175 psi (12,1 bar)					
	Recessed Pendent (TY4251)	175 psi (12,1 bar)			N/A		
8.0 1/2 in. NPT	Upright (TY4851) and Pendent (TY4951)	175 psi (12,1 bar)					
NOTES 1. Frame and deflector only 2. The maximum working pressure of 250 psi (17,2 bar) only applies to the Listing by Underwriters Laboratories, Inc. (UL), the Listing by Underwriters Laboratories, Inc. for use in Canada (C-UL), and the Approval by the City of New York. 3. Not Applicable (N/A)							
TABLE B SERIES TY-B UPRIGHT AND PENDENT SPRINKLERS MAXIMUM WORKING PRESSURE							

torque of 10 to 20 lb-ft (13,4 to 26,8 N·m). Higher levels of torque may distort the sprinkler inlet and cause leakage or impairment of the sprinkler.

Do not attempt to compensate for insufficient adjustment in the escutcheon plate by under- or over-tightening the sprinkler. Re-adjust the position of the sprinkler fitting to suit.

Series TY-B Upright and Pendent Sprinklers Installation

The Series TY-B Upright and Pendent Sprinklers must be installed in accordance with the following instructions:

Step 1. Install pendent sprinklers in the pendent position. Install upright sprinklers in the upright position.

Step 2. With pipe thread sealant applied to the pipe threads, hand-tighten the sprinkler into the sprinkler fitting.

Step 3. Tighten the sprinkler into the sprinkler fitting using only the W-Type 6 Sprinkler Wrench (Ref. Figure 7). For wax-coated sprinklers, use an 8 or 10 in. adjustable wrench. With reference to Figure 1 to 4, apply the W-Type 6 Recessed Sprinkler Wrench or an adjustable wrench, as applicable, to the sprinkler wrench flats.

Wax Coated Sprinklers

When installing wax-coated sprinklers with an adjustable wrench, take care to prevent damage to the wax coating on the sprinkler wrench flats or frame arms and, consequently, exposure of bare metal to the corrosive environment:

- Open the jaws of the wrench sufficiently wide to pass over the wrench flats without damaging the wax coating.
- Before wrench tightening the sprinkler, adjust the jaws of the wrench to contact only the sprinkler wrench flats.
- After wrench tightening the sprinkler, loosen the wrench jaws before removing the wrench.

After Installation

After installation, complete the following:

- Inspect the sprinkler wrench flats and frame arms and retouch (repair) the wax coating whenever the coating has been damaged and bare metal is exposed.
- Retouch the wax coating on the wrench flats by gently applying a heated 1/8 inch diameter steel rod to the damaged areas of wax, to smooth it back over areas where bare metal is exposed.

NOTICE

Only retouching of the wax coating applied to the wrench flats and frame arms is permitted, and the retouching is to be performed only at the time of the initial sprinkler installation.

The steel rod should be heated only to the point it can begin to melt the wax, and appropriate precautions need to be taken when handling the heated rod in order to prevent the installer from being burned.

Series TY-B Recessed Pendent Sprinklers

The Series TY-B Recessed Pendent Sprinklers must be installed in accordance with the following instructions:

Step 1. After installing the Style 10 or 40 Mounting Plate, as applicable, over the sprinkler threads and with pipe thread sealant applied to the pipe threads, hand-tighten the sprinkler into the sprinkler fitting.

Step 2. Tighten the sprinkler into the sprinkler fitting using only the W-Type 7 Recessed Sprinkler Wrench (Ref. Figure 8). With reference to Figure 3 or 4, apply the W-Type 7 Recessed Sprinkler wrench to the sprinkler wrench flats.

Step 3. After the ceiling is installed or the finish coat is applied, slide on the Style 10 or 40 Closure over the Series TY-B Recessed Pendent Sprinkler and push the Closure over the Mounting Plate until its flange contacts the ceiling.

Care and Maintenance

The TYCO Series TY-B 2.8, 5.6, and 8.0 K-factor, Upright, Pendent, and Recessed Pendent Sprinklers must be maintained and serviced in accordance with this section.

Before closing a fire protection system main control valve for maintenance work on the fire protection system that it controls, obtain permission to shut down the affected fire protection system from the proper authorities and notify all personnel who may be affected by this action.

The owner must assure that the sprinklers are not used for hanging any objects and that the sprinklers are only cleaned by means of gently dusting with a feather duster; otherwise, non-operation in the event of a fire or inadvertent operation may result.

Absence of an escutcheon, which is used to cover a clearance, may delay the time to sprinkler operation in a fire situation.

Sprinklers which are found to be leaking or exhibiting visible signs of corrosion must be replaced.

Automatic sprinklers must never be painted, plated, coated, or otherwise altered after leaving the factory. Modified sprinklers must be replaced. Sprinklers that have been exposed to corrosive products of combustion, but have not operated, should be replaced if they cannot be completely cleaned by wiping the sprinkler with a cloth or by brushing it with a soft bristle brush.

Care must be exercised to avoid damage to the sprinklers before, during, and after installation. Sprinklers damaged by dropping, striking, wrench twist/slippage, or the like, must be replaced. Also, replace any sprinkler that has a cracked bulb or that has lost liquid from its bulb. Refer to the Installation Section.

The owner is responsible for the inspection, testing, and maintenance of their fire protection system and devices in compliance with this document, as well as with the applicable standards of the National Fire Protection Association, (e.g., NFPA 25), in addition to the standards of any other authorities having jurisdiction. Contact the installing contractor or product manufacturer with any questions.

Automatic sprinkler are recommended to be inspected, tested, and maintained by a qualified Inspection Service in accordance with local requirements and/or national codes.

P/N 57 - XXX - X - XXX							
		SIN			SPRINKLER FINISH		
530	2.8K UPRIGHT (1/2 in. NPT)	TY1151	1		NATURAL BRASS	135	135°F (57°C)
531	2.8K PENDENT (1/2 in. NPT)	TY1251	2		POLY-STAINLESS GREY ALUMINUM (RAL9007) ¹ POLYESTER	155	155°F (68°C)
570	5.6K UPRIGHT (1/2 in. NPT)	TY3151	3		PURE WHITE (RAL9010) ² POLYESTER	175	175°F (79°C)
571	5.6K PENDENT (1/2 in. NPT)	TY3251	4		SIGNAL WHITE (RAL9003) POLYESTER	200	200°F (93°C)
590	8.0K UPRIGHT (3/4 in. NPT)	TY4151	5		JET BLACK (RAL9005) ³ POLYESTER	286	286°F (141°C)
591	8.0K PENDENT (3/4 in. NPT)	TY4251	6		WAX COATED 286°F (141°C) MAX	360	360°F (182°C)
560	8.0K UPRIGHT (1/2 in. NPT)	TY4851	7		LEAD COATED	000	OPEN ⁴
561	8.0K PENDENT (1/2 in. NPT)	TY4951	8		WAX-OVER-LEAD 286°F (141°C) MAX		
			9		CHROME PLATED		

NOTES

- Only available on TY3151, TY3251, TY4151, and TY4251.
- Eastern Hemisphere sales only.
- Available in only 8.0K, 155°F (68°C) or 200°F (93°C); requires lead time to manufacture.
- Available only for 8.0 K-factor TY4151 and TY4251 for use in deluge systems ("OPEN" indicates sprinkler assembly without glass bulb, button, and sealing assembly).

TABLE C
SERIES TY-B UPRIGHT AND PENDENT SPRINKLERS
PART NUMBER SELECTION

Limited Warranty

For warranty terms and conditions, visit www.tyco-fire.com.

Ordering Procedure

Contact your local distributor for availability. When placing an order, indicate the full product name and Part Number (P/N).

Sprinkler Assemblies with NPT Thread Connections

Specify: Series TY-B (specify SIN), (specify K-factor), (specify Upright or Pendent) Sprinkler with (specify) temperature rating, (specify) finish or coating, P/N (Refer to Table C)

Recessed Escutcheon

Specify: Style (10 or 40) Recessed Escutcheon with (specify*) finish, P/N (specify*)

* Refer to Technical Data Sheet TFP770

Sprinkler Wrenches

Specify: W-Type 6 Sprinkler Wrench, P/N 56-000-6-387

Specify: W-Type 7 Sprinkler Wrench, P/N 56-850-4-001

Wax Sticks (for retouching wrench-damaged wax coating)

Specify: (specify color, below) Color-coded Wax Sticks for retouching (specify temperature rating) temperature-rated Series TY-B Sprinklers, P/N (specify)

Black for 135°F (57°C) P/N 56-065-1-135
Red for 155°F (68°C) P/N 56-065-1-155
Yellow for 175°F (79°C) P/N 56-065-1-175
Blue for 200°F (93°C)
and 286°F (141°C) P/N 56-065-1-286

Note: Each wax stick is suitable for retouching up to 25 sprinklers.

The wax used for 286°F (141°C) sprinklers is the same as for 200°F (93°C) sprinklers. Therefore, the 286°F (141°C) sprinkler is limited to the same maximum ceiling temperature as the 200°F (93°C) sprinkler which is 150°F (66°C).

Series TY-FRB – 2.8, 4.2, 5.6, and 8.0 K-Factor Upright, Pendent, and Recessed Pendent Sprinklers Quick Response, Standard Coverage

IMPORTANT

Refer to Technical Data Sheet TFP2300 for warnings pertaining to regulatory and health information.

Always refer to Technical Data Sheet TFP700 for the "INSTALLER WARNING" that provides cautions with respect to handling and installation of sprinkler systems and components. Improper handling and installation can permanently damage a sprinkler system or its components and cause the sprinkler to fail to operate in a fire situation or cause it to operate prematurely.

Scan the QR code or enter the URL in a web browser to access the most up-to-date electronic version of this document. Data rates may apply.



docs.jci.com/tycofire/tpf171

General Description

The TYCO Series TY-FRB 2.8, 4.2, 5.6, and 8.0 K-factor Upright, Pendent, and Recessed Pendent Sprinklers described in herein are quick response, standard coverage, decorative 3 mm glass bulb-type spray sprinklers. They are designed for use in light or ordinary hazard, commercial occupancies such as banks, hotels, and shopping malls.

The sprinkler, where applicable, is intended for use in areas with a finished

ceiling. This recessed pendent sprinkler uses one of the following recessed escutcheons:

- Two-piece Style 10 (1/2 in. NPT) or Style 40 (3/4 in. NPT) Recessed Escutcheon with 1/2 in. (12,7 mm) of recessed adjustment or up to 3/4 in. (19,1 mm) of total adjustment from the flush pendent position.
- Two-piece Style 20 (1/2 in. NPT) or Style 30 (3/4 in. NPT) Recessed Escutcheon with 1/4 in. (6,4 mm) of recessed adjustment or up to 1/2 in. (12,7 mm) of total adjustment from the flush pendent position.


The adjustment provided by the recessed escutcheon reduces the accuracy to which the fixed pipe drops to the sprinklers must be cut.

Corrosion-resistant coatings, where applicable, are utilized to extend the life of copper alloy sprinklers beyond what would be obtained when exposed to corrosive atmospheres. Although corrosion-resistant coated sprinklers have passed the standard corrosion tests of the applicable approval agencies, the testing is not representative of all possible corrosive atmospheres. Consequently, it is recommended that the end user be consulted with respect to the suitability of these coatings for any given corrosive environment. The effects of ambient temperature, concentration of chemicals, and gas/chemical velocity, should be considered, as a minimum, along with the corrosive nature of the chemical to which the sprinklers will be exposed.

An intermediate level version of the Series TY-FRB Pendent Sprinklers is detailed in technical data sheet TFP356. Sprinkler guards are detailed in technical data sheet TFP780.

NOTICE

The Series TY-FRB 2.8, 4.2, 5.6, and 8.0 K-factor Upright, Pendent, and Recessed Pendent Sprinklers described herein must be installed and maintained in compliance with this document and with the applicable standards of the National Fire Protection Association (NFPA), in addition to

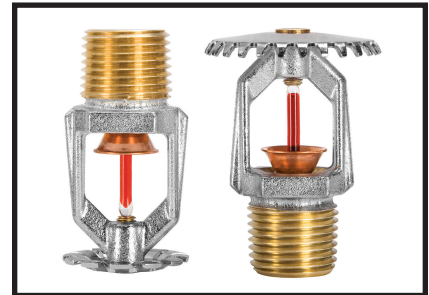



the standards of any authorities having jurisdiction. Failure to do so may impair the performance of these devices.

The owner is responsible for maintaining their fire protection system and devices in proper operating condition. The installing contractor or sprinkler manufacturer should be contacted with any questions.

NFPA 13 prohibits installation of 1/2 in. NPT sprinklers with K-factors greater than 5.6 in new construction. They are intended for retrofit in existing sprinkler systems only.

Sprinkler Identification Number (SIN)

TY1131 . . . Upright 2.8K, 1/2 in. NPT
TY1231 . . . Pendent 2.8K, 1/2 in. NPT
TY2131 . . . Upright 4.2K, 1/2 in. NPT
TY2231 . . . Pendent 4.2K, 1/2 in. NPT
TY3131 . . . Upright 5.6K, 1/2 in. NPT
TY3231 . . . Pendent 5.6K, 1/2 in. NPT
TY4131 . . . Upright 8.0K, 3/4 in. NPT
TY4231 . . . Pendent 8.0K, 3/4 in. NPT
TY4831 . . . Upright 8.0K, 1/2 in. NPT
TY4931 . . . Pendent 8.0K, 1/2 in. NPT

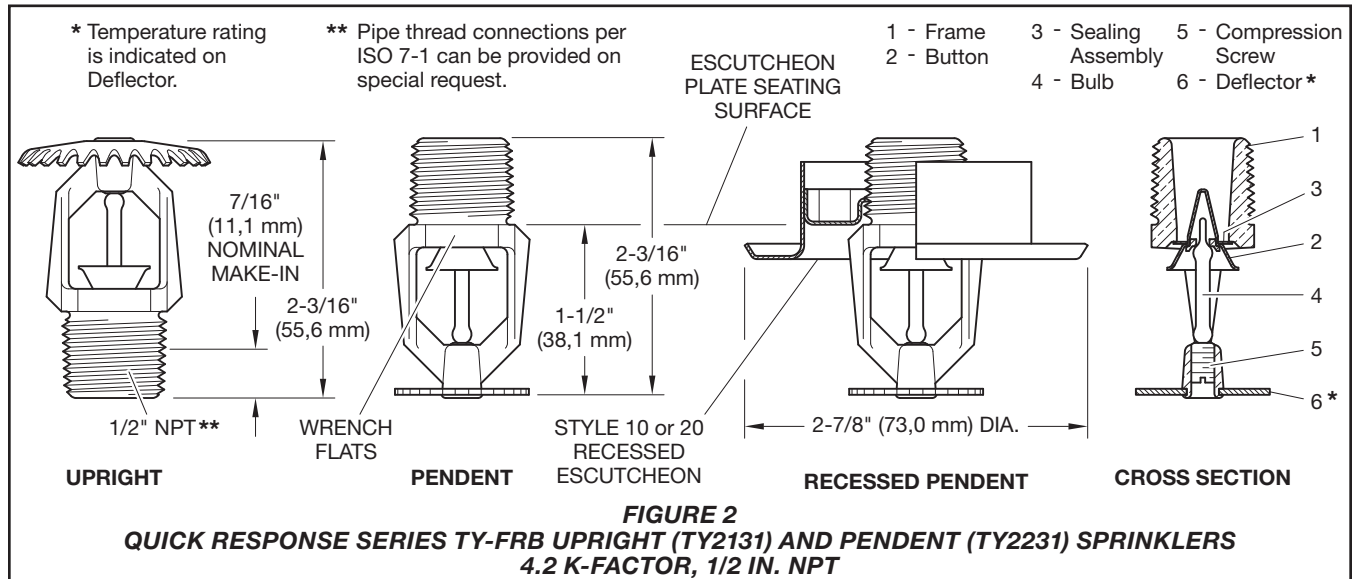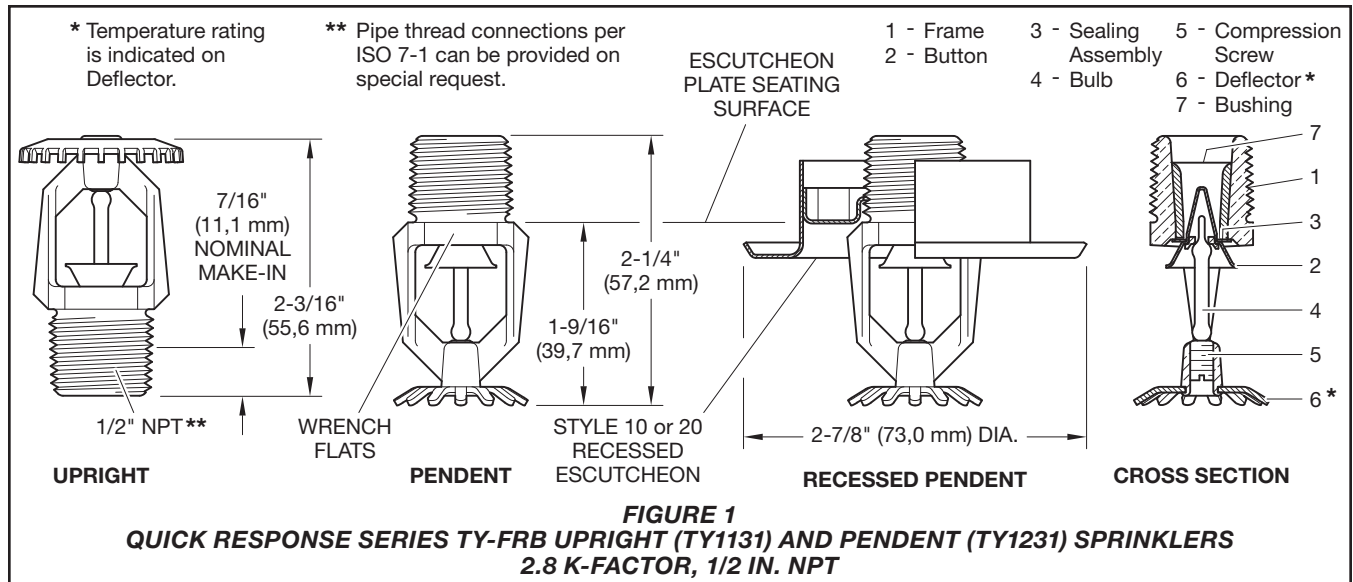

Technical Data

Approvals

UL and C-UL Listed
 FM, LPCB, and NYC Approved
 EAC Approved

Note: For complete approval information, including corrosion-resistant status, see Tables A, B, C and D.

Maximum Working Pressure

See Table E

Discharge Coefficient

K=2.8 gpm/psi^{1/2} (40,3 Lpm/bar^{1/2})
 K=4.2 gpm/psi^{1/2} (60,5 Lpm/bar^{1/2})
 K=5.6 gpm/psi^{1/2} (80,6 Lpm/bar^{1/2})
 K=8.0 gpm/psi^{1/2} (115,2 Lpm/bar^{1/2})

Temperature Rating

See Tables A and B

Finishes

Sprinkler: See Table D

Recessed Escutcheon: Signal or Pure White, Grey Aluminum, Jet Black, Chrome Plated, or Natural Brass

Physical Characteristics




Frame Bronze
 Button Brass/Copper
 Sealing Assembly . . . Beryllium Nickel w/TEFLON
 Bulb Glass
 Compression Screw Bronze
 Deflector Copper/Bronze
 Bushing (K=2.8) Bronze

Operation

The glass bulb contains a fluid that expands when exposed to heat. When the rated temperature is reached, the fluid expands sufficiently to shatter the glass bulb, allowing the sprinkler to activate and water to flow.

Design Criteria

The TYCO Series TY-FRB 2.8, 4.2, 5.6, and 8.0 K-factor Upright, Pendent, and Recessed Pendent Sprinklers are intended for fire protection systems designed in accordance with the standard installation rules recognized by the applicable Listing or Approval agency, such as UL Listing based on the requirements of NFPA 13 and FM Approval based on the requirements of the FM Global Loss Prevention Data Sheets. Use only the style 10, 20, 30, or 40 recessed escutcheon, as applicable, for recessed pendent installations.

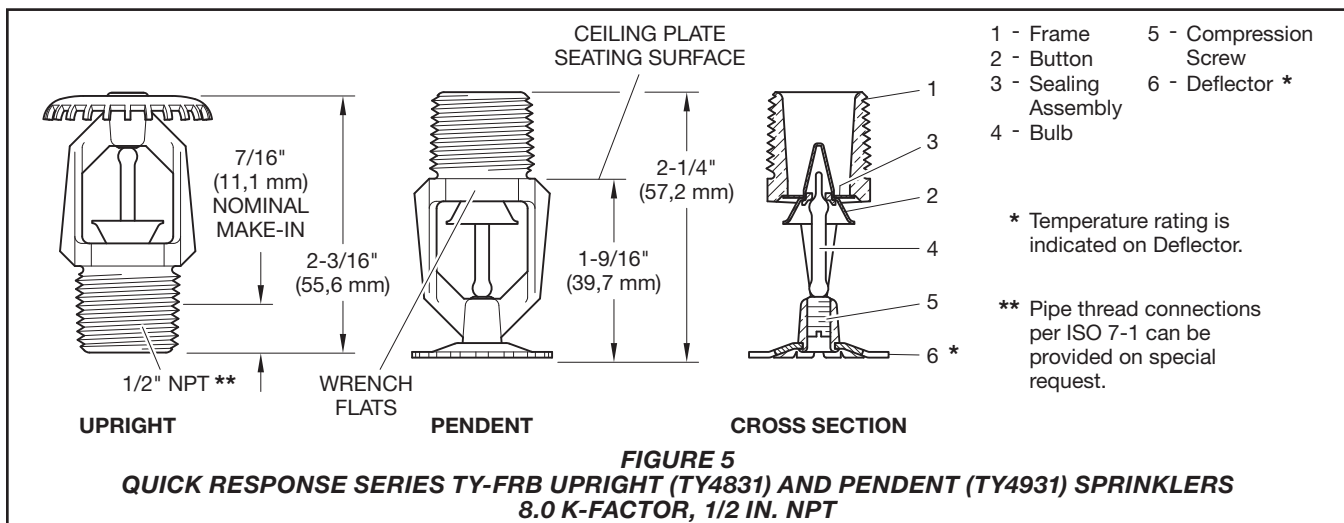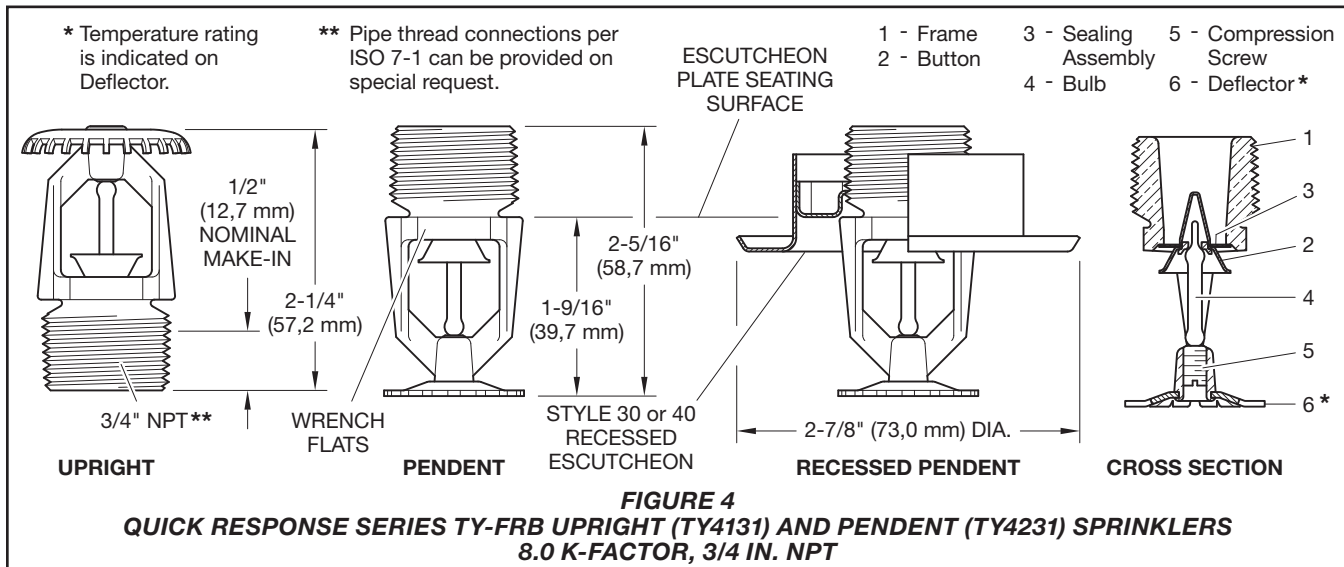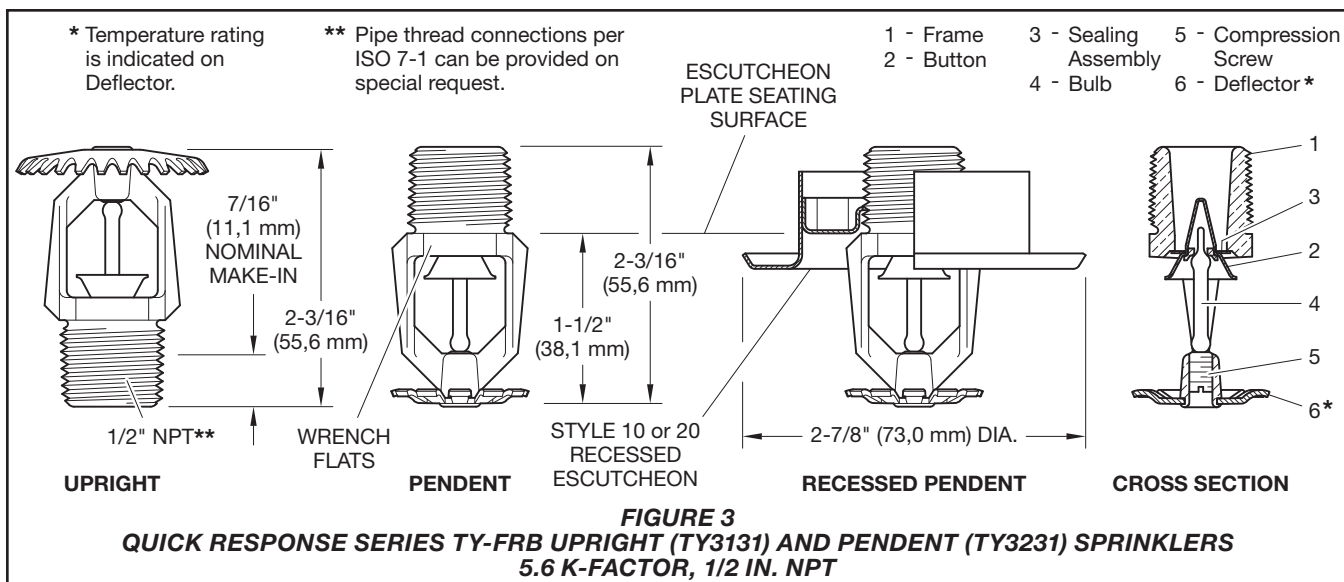

Installation

The TYCO Series TY-FRB 2.8, 4.2, 5.6, and 8.0 K-factor Upright, Pendent, and Recessed Pendent Sprinklers must be installed in accordance with this section.

General Instructions

Do not install any bulb type sprinkler if the bulb is cracked or there is a loss of liquid from the bulb. With the sprinkler held horizontally, a small air bubble should be present. The diameter of the air bubble is approximately 1/16 in. (1,6 mm) for the 135°F (57°C) and 3/32 in. (2,4 mm) for the 286°F (141°C) temperature ratings. A leak-tight 1/2 in. NPT sprinkler joint should be obtained by applying a minimum-to-maximum torque of 7 ft-lb to 14 ft-lb (9,5 N·m to 19,0 N·m). A leak tight 3/4 in. NPT sprinkler joint should be obtained with a torque of 10 ft-lb to 20 ft-lb (13,4 N·m to 26,8 N·m). Higher levels of torque can distort the sprinkler inlet and cause leakage or impairment of the sprinkler. Do not attempt to compensate for insufficient adjustment in the escutcheon plate by under or over-tightening the sprinkler. Re-adjust the position of the sprinkler fitting to suit.

Series TY-FRB Upright and Pendent Sprinklers

The Series TY-FRB Upright and Pendent Sprinklers must be installed in accordance with the following instructions:

Step 1. Install pendent sprinklers in the pendent position. Install upright sprinklers in the upright position.

Step 2. With pipe thread sealant applied to the pipe threads, hand-tighten the sprinkler into the sprinkler fitting.

Step 3. Tighten the sprinkler into the sprinkler fitting using only the W-Type 6 Sprinkler Wrench as shown in Figure 14. Apply the sprinkler wrench to the sprinkler wrench flats as shown in Figure 1 to Figure 5.

Series TY-FRB Recessed Pendent Sprinklers

The Series TY-FRB Recessed Pendent Sprinklers must be installed in accordance with the following instructions:

Step 1. After installing the Style 10, 20, 30, or 40 Mounting Plate, as applicable, over the sprinkler threads and with pipe-thread sealant applied to the pipe threads, hand-tighten the sprinkler into the sprinkler fitting.

Step 2. Tighten the sprinkler into the sprinkler fitting using only the W-Type 7 Recessed Sprinkler Wrench as shown in Figure 15. Apply the sprinkler wrench to the sprinkler wrench flats as shown in Figure 1 to 4.

Step 3. After the ceiling is installed or the finish coat is applied, slide on the Style 10, 20, 30, or 40 closure over the Series TY-FRB Recessed Pendent Sprinkler and push the closure over the mounting plate until its flange comes in contact with the ceiling.

Care and Maintenance

The TYCO Series TY-FRB 2.8, 4.2, 5.6, and 8.0 K-factor Upright, Pendent, and Recessed Pendent Sprinklers must be maintained and serviced in accordance with this section. Before closing a fire protection system main control valve for maintenance work on the fire protection system that it controls, obtain permission to shut down the affected fire protection systems from the proper authorities and notify all personnel who may be affected by this action.

Absence of the outer piece of an escutcheon, which is used to cover a clearance hole, can delay sprinkler operation in a fire situation.

Sprinklers which are found to be leaking or exhibiting visible signs of corrosion must be replaced.

Automatic sprinklers must never be painted, plated, coated, or otherwise altered after leaving the factory. Modified sprinklers must be replaced. Sprinklers that have been exposed to

corrosive products of combustion, but have not operated, should be replaced if they cannot be completely cleaned by wiping the sprinkler with a cloth or by brushing it with a soft bristle brush.





Care must be taken to avoid damage to the sprinklers before, during, and after installation. Sprinklers damaged by dropping, striking, wrench twist/slippage, or the like, must be replaced. Also, replace any sprinkler that has a cracked bulb or that has lost liquid from its bulb. For more information, see Installation section.







The owner is responsible for the inspection, testing, and maintenance of their fire protection system and devices in compliance with this document, as well as with the applicable standards of the National Fire Protection Association such as NFPA 25, in addition to the standards of any other authorities having jurisdiction. Contact the installing contractor or sprinkler manufacturer regarding any questions.

Automatic sprinkler systems are recommended to be inspected, tested, and maintained by a qualified Inspection Service in accordance with local requirements and/or national codes.

Care must be exercised to avoid damage to the sprinklers before, during, and after installation. Sprinklers damaged by dropping, striking, wrench twist/slippage, or the like, must be replaced. Also, replace any sprinkler that has a cracked bulb or that has lost liquid from its bulb. For more information, see Installation section.

Initial and frequent visual inspections of random samples are recommended for corrosion-resistant sprinklers to verify the integrity of the corrosion-resistant material of construction. Thereafter, annual inspections according to NFPA 25 should suffice. Inspections of corrosion-resistant sprinklers are recommended at close range, instead of from the floor level per NFPA. Inspection at close range can better determine the exact sprinkler condition and the long-term integrity of the corrosion-resistant material, which can be affected by the corrosive conditions present.

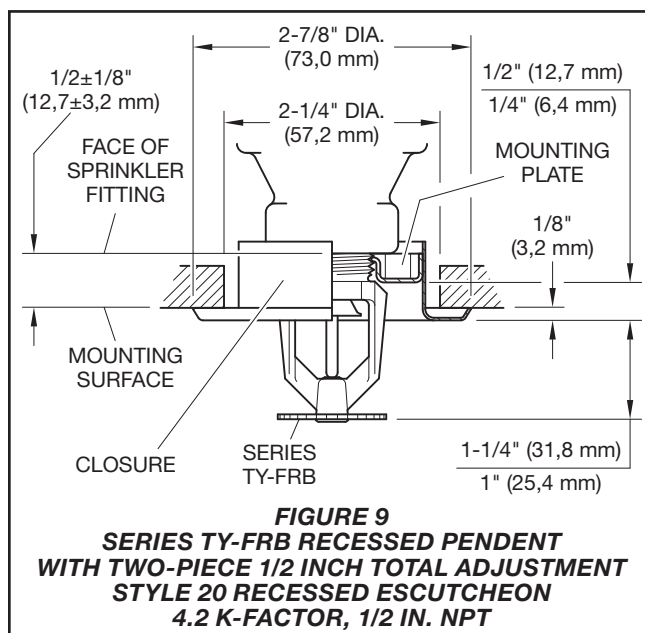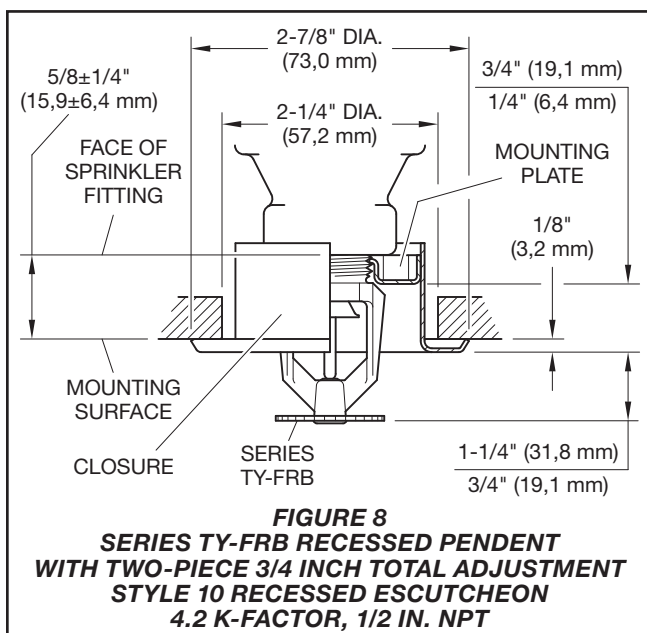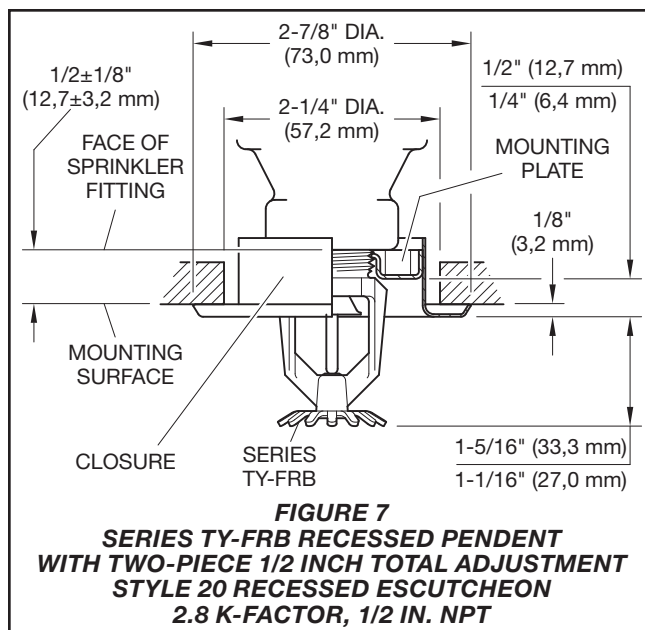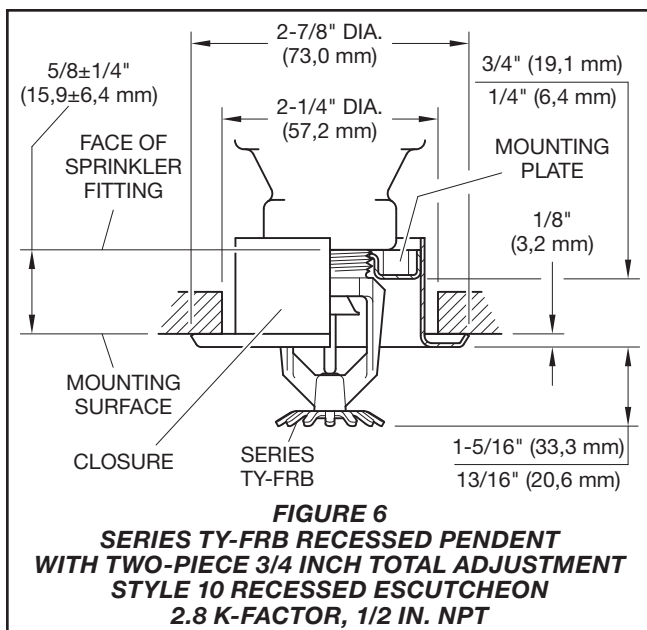

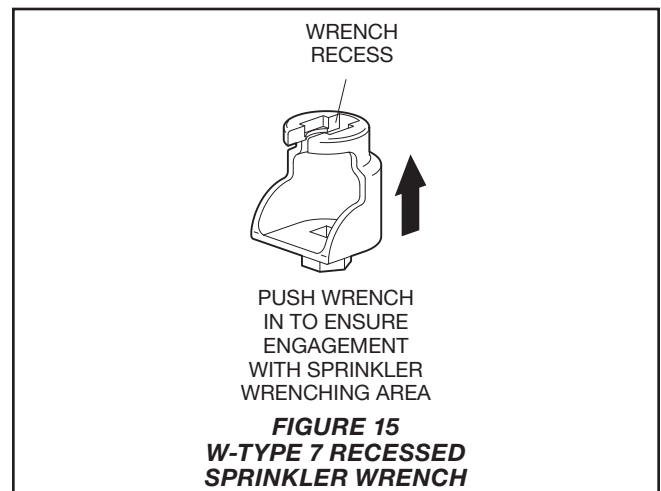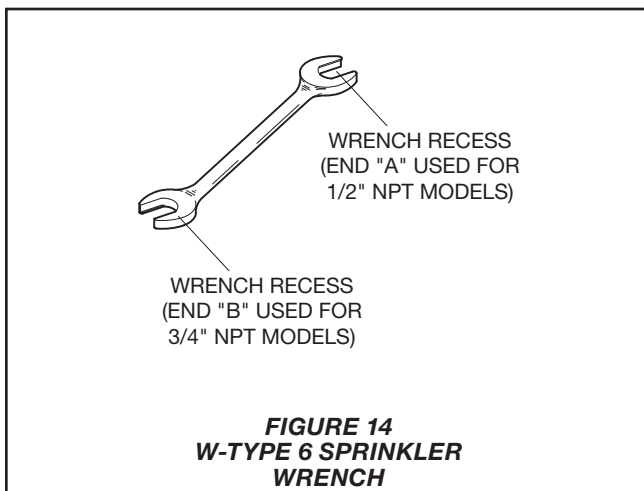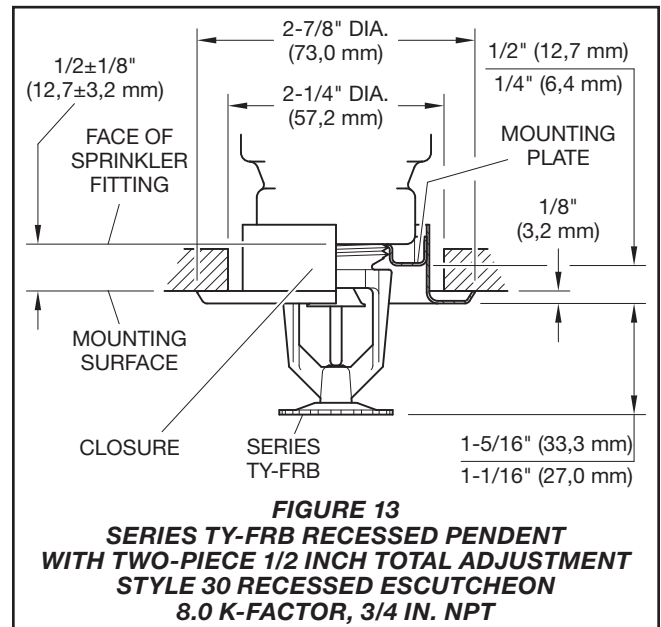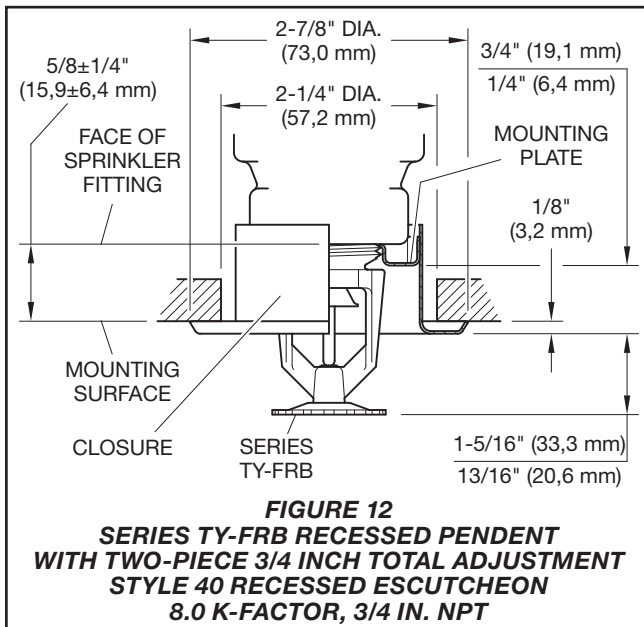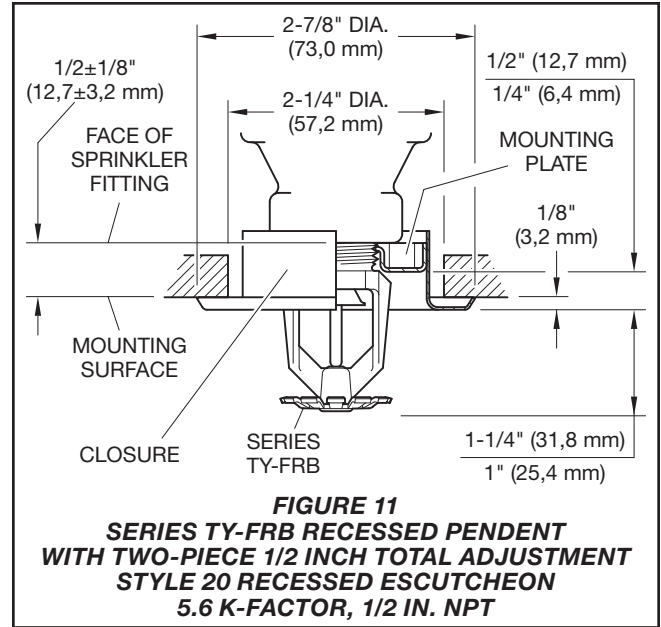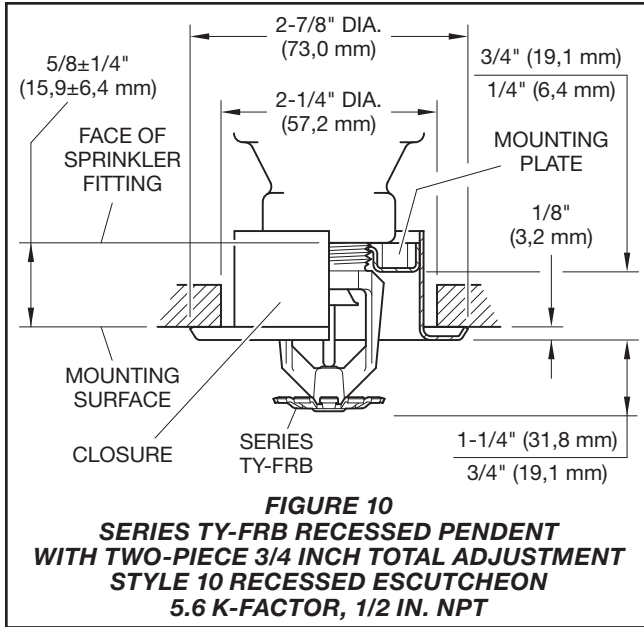

K-Factor	Type	Temperature	Bulb Liquid Color	Sprinkler Finish ⁵		
				Natural Brass	Chrome Plated	Polyester ^c
2.8 1/2 in. NPT	Pendent (TY1231)	135°F (57°C)	Orange	1, 2, 3, 4		
		155°F (68°C)	Red			
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
		286°F (141°C)	Blue			
	Upright (TY1131)	135°F (57°C)	Orange			
		155°F (68°C)	Red			
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
		286°F (141°C)	Blue			
	Recessed Pendent (TY1231) ^a Figure 6	135°F (57°C)	Orange	1, 2, 4		
		155°F (68°C)	Red			
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
	Recessed Pendent (TY1231) ^b Figure 7	135°F (57°C)	Orange			
		155°F (68°C)	Red			
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			

NOTES

a. Installed with Style 10 (1/2 in. NPT) or Style 40 (3/4 in. NPT) 3/4 in. Total Adjustment Recessed Escutcheon, as applicable.

b. Installed with Style 20 (1/2 in. NPT) or Style 30 (3/4 in. NPT) 1/2 in. Total Adjustment Recessed Escutcheon, as applicable.

c. Frame and Deflector only.

1. Listed by Underwriters Laboratories, Inc., (UL) as Quick Response Sprinklers.

2. Listed by Underwriters Laboratories, Inc., for use in Canada (C-UL) as Quick Response Sprinklers.

3. Approved by Factory Mutual Research Corporation (FM) as Quick Response Sprinklers.

4. Approved by the City of New York under MEA 354-01-E.

5. Where Polyester Coated Sprinklers are noted to be UL and C-UL Listed, the sprinklers are UL and C-UL Listed as corrosion-resistant sprinklers.

TABLE A
LABORATORY LISTINGS AND APPROVALS FOR
2.8 K-FACTOR SPRINKLERS

K-Factor	Type	Temperature	Bulb Liquid Color	Sprinkler Finish ³		
				Natural Brass	Chrome Plated	Polyester ^c
4.2 1/2 in. NPT	Pendent (TY2231)	135°F (57°C)	Orange	1, 2		
		155°F (68°C)	Red			
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
		286°F (141°C)	Blue			
	Upright (TY2131)	135°F (57°C)	Orange			
		155°F (68°C)	Red			
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
		286°F (141°C)	Blue			
	Recessed Pendent (TY2231) ^a Figure 8	135°F (57°C)	Orange			
		155°F (68°C)	Red			
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
	Recessed Pendent (TY2231) ^b Figure 9	135°F (57°C)	Orange			
		155°F (68°C)	Red			
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			

NOTES

- Installed with Style 10 (1/2 in. NPT) or Style 40 (3/4 in. NPT) 3/4 in. Total Adjustment Recessed Escutcheon, as applicable.
 - Installed with Style 20 (1/2 in. NPT) or Style 30 (3/4 in. NPT) 1/2 in. Total Adjustment Recessed Escutcheon, as applicable.
 - Frame and Deflector only.
- Listed by Underwriters Laboratories, Inc., (UL) as Quick Response Sprinklers.
 - Listed by Underwriters Laboratories, Inc., for use in Canada (C-UL) as Quick Response Sprinklers.
 - Where Polyester Coated Sprinklers are noted to be UL and C-UL Listed, the sprinklers are UL and C-UL Listed, the sprinklers are UL and C-UL Listed as corrosion-resistant sprinklers.

TABLE B
LABORATORY LISTINGS AND APPROVALS FOR
4.2 K-FACTOR SPRINKLERS

K-Factor	Type	Temperature	Bulb Liquid Color	Sprinkler Finish ^a			
				Natural Brass	Chrome Plated	Polyester ^c	Lead Coated
5.6 1/2 in. NPT	Pendent (TY3231)	135°F (57°C)	Orange	1, 2, 3, 4, 5, 6, 7			1, 2, 3, 5, 7
		155°F (68°C)	Red				
		175°F (79°C)	Yellow				
		200°F (93°C)	Green				
		286°F (141°C)	Blue				
	Upright (TY3131)	135°F (57°C)	Orange	1, 2, 3, 5, 6, 7			1, 2, 3, 5, 7
		155°F (68°C)	Red				
		175°F (79°C)	Yellow				
		200°F (93°C)	Green				
		286°F (141°C)	Blue				
	Recessed Pendent (TY3231) ^a Figure 10	135°F (57°C)	Orange	1, 2, 4, 5, 7			N/A ^d
		155°F (68°C)	Red				
		175°F (79°C)	Yellow				
		200°F (93°C)	Green				
		286°F (141°C)	Blue				
	Recessed Pendent (TY3231) ^b Figure 11	135°F (57°C)	Orange	1, 2, 3, 4, 5, 7			N/A
		155°F (68°C)	Red				
		175°F (79°C)	Yellow				
		200°F (93°C)	Green				
		286°F (141°C)	Blue				

NOTES

a. Installed with Style 10 (1/2 in. NPT) or Style 40 (3/4 in. NPT) 3/4 in. Total Adjustment Recessed Escutcheon, as applicable.

b. Installed with Style 20 (1/2 in. NPT) or Style 30 (3/4 in. NPT) 1/2 in. Total Adjustment Recessed Escutcheon, as applicable.

c. Frame and Deflector only.

d. Not available (N/A).

1. Listed by Underwriters Laboratories, Inc., (UL) as Quick Response Sprinklers.

2. Listed by Underwriters Laboratories, Inc., for use in Canada (C-UL) as Quick Response Sprinklers.

3. Approved by Factory Mutual Research Corporation (FM) as Quick Response Sprinklers.

4. Approved by the Loss Prevention Certification Board (LPCB Ref. No. 007k/04) as Quick Response Sprinklers. Note the following exceptions:

- LPCB does not rate the thermal sensitivity of recessed sprinklers.
- The recessed pendent (TY3231) sprinklers with a 286°F (141°C) temperature rating are not LPCB Approved.

5. Approved by the City of New York under MEA 354-01-E.

6. VdS Approved (For details, contact Johnson Controls, Enschede, Netherlands, Tel. 31-53-428-4444/Fax 31-53-428-3377.)

7. EAC Approved.

8. Where Polyester Coated and Lead-Coated Sprinklers are noted to be UL and C-UL Listed, the sprinklers are UL and C-UL Listed as Corrosion-Resistant Sprinklers. Where Lead-Coated Sprinklers are noted to be FM Approved, the sprinklers are FM Approved as a Corrosion-Resistant Sprinklers.

TABLE C

LABORATORY LISTINGS AND APPROVALS FOR

5.6 K-FACTOR SPRINKLERS

K-Factor	Type	Temperature	Bulb Liquid Color	Sprinkler Finish ⁹				
				Natural Brass	Chrome Plated	Polyester ^c	Lead Coated	
8.0 3/4 in. NPT	Pendent (TY4231)	135°F (57°C)	Orange	1, 2, 3, 4, 5, 6, 7, 8				1, 2, 5, 8
		155°F (68°C)	Red					
		175°F (79°C)	Yellow					
		200°F (93°C)	Green					
		286°F (141°C)	Blue					
	Upright (TY4131)	135°F (57°C)	Orange					
		155°F (68°C)	Red					
		175°F (79°C)	Yellow					
		200°F (93°C)	Green					
		286°F (141°C)	Blue					
	Recessed Pendent (TY4231) ^a Figure 12	135°F (57°C)	Orange	1, 2, 5, 8				N/A ^d
		155°F (68°C)	Red					
		175°F (79°C)	Yellow					
		200°F (93°C)	Green					
		286°F (141°C)	Blue					
	Recessed Pendent (TY4231) ^b Figure 13	135°F (57°C)	Orange	1, 2, 3, 5, 8				N/A
155°F (68°C)		Red						
175°F (79°C)		Yellow						
200°F (93°C)		Green						
286°F (141°C)		Blue						
8.0 1/2 in. NPT	Pendent (TY4931)	135°F (57°C)	Orange	1, 2, 4, 5, 6, 8				1, 2, 5, 8
		155°F (68°C)	Red					
		175°F (79°C)	Yellow					
		200°F (93°C)	Green					
		286°F (141°C)	Blue					
	Upright (TY4831)	135°F (57°C)	Orange					
		155°F (68°C)	Red					
		175°F (79°C)	Yellow					
		200°F (93°C)	Green					
		286°F (141°C)	Blue					

NOTES

- a. Installed with Style 10 (1/2 in. NPT) or Style 40 (3/4 in. NPT) 3/4 in. Total Adjustment Recessed Escutcheon, as applicable.
- b. Installed with Style 20 (1/2 in. NPT) or Style 30 (3/4 in. NPT) 1/2 in. Total Adjustment Recessed Escutcheon, as applicable.
- c. Frame and Deflector only.
- d. Not available (N/A).
1. Listed by Underwriters Laboratories, Inc., (UL) as Quick Response Sprinklers.
2. Listed by Underwriters Laboratories, Inc., for use in Canada (C-UL) as Quick Response Sprinklers.
3. Approved by Factory Mutual Research Corporation (FM) as Quick Response Sprinklers.
4. Approved by the Loss Prevention Certification Board (LPCB Ref. No. 007k/04) as Quick Response Sprinklers. However, LPCB does not rate the thermal sensitivity of recessed sprinklers.
5. Approved by the City of New York under MEA 354-01-E.
6. VdS Approved (For details, contact Johnson Controls, Enschede, Netherlands, Tel. 31-53-428-4444/Fax 31-53-428-3377.)
7. Approved by the Loss Prevention Certification Board (LPCB Ref. No. 094a/06) as Quick Response Sprinklers.
8. EAC Approved.
9. Where Polyester Coated and Lead-Coated Sprinklers are noted to be UL and C-UL Listed, the sprinklers are UL and C-UL Listed as Corrosion-Resistant Sprinklers. Where Lead-Coated Sprinklers are noted to be FM Approved, the sprinklers are FM Approved as a Corrosion-Resistant Sprinklers.

TABLE D
LABORATORY LISTINGS AND APPROVALS FOR
8.0 K-FACTOR SPRINKLERS

K-Factor	Type	Sprinkler Finish			
		Natural Brass	Chrome Plated	Polyester	Lead Coated
2.8 1/2 in. NPT	Pendent (TY1231) and Upright (TY1131)	175 psi (12,1 bar)			N/A ²
	Recessed Pendent (TY1231)				
4.2 1/2 in. NPT	Pendent (TY2231) and Upright (TY2131)	175 psi (12,1 bar)			N/A
	Recessed Pendent (TY2231)				
5.6 1/2 in. NPT	Pendent (TY3231) and Upright (TY3131)	250 psi (17,2 bar) or 175 psi (12,1 bar) ¹			
	Recessed Pendent (TY3231)				
8.0 3/4 in. NPT	Pendent (TY4231) and Upright (TY4131)	175 psi (12,1 bar)			175 psi (12,1 bar)
	Recessed Pendent(TY4231)				N/A
8.0 1/2 in. NPT	Pendent (TY4931) and Upright (TY4831)	175 psi (12,1 bar)			175 psi (12,1 bar)
NOTES 1. The maximum working pressure of 250 psi (17,2 bar) only applies to the Listing by Underwriters Laboratories Inc. (UL); the Listing by Underwriters Laboratories, Inc. for use in Canada (C-UL); and, the Approval by the City of New York. 2. Not available (N/A).					
TABLE E MAXIMUM WORKING PRESSURE					

P/N 57 – XXX – X – XXX						
		SIN	SPRINKLER FINISH		TEMPERATURE RATINGS	
330	2.8K UPRIGHT (1/2 in. NPT)	TY1131	1	NATURAL BRASS	135	135°F (57°C)
331	2.8K PENDENT (1/2 in. NPT)	TY1231	3	PURE WHITE POLYESTER (RAL9010) ¹	155	155°F (68°C)
340	4.2K UPRIGHT (1/2 in. NPT)	TY2131	4	SIGNAL WHITE POLYESTER (RAL9003)	175	175°F (79°C)
341	4.2K PENDENT (1/2 in. NPT)	TY2231	5	JET BLACK POLYESTER (RAL9005) ²	200	200°F (93°C)
370	5.6K UPRIGHT (1/2 in. NPT)	TY3131	7	LEAD COATED	286	286°F (141°C)
371	5.6K PENDENT (1/2 in. NPT)	TY3231	9	CHROME PLATED		
390	8.0K UPRIGHT (3/4 in. NPT)	TY4131				
391	8.0K PENDENT (3/4 in. NPT)	TY4231				
360	8.0K UPRIGHT (1/2 in. NPT)	TY4831				
361	8.0K PENDENT (1/2 in. NPT)	TY4931				

NOTES
1. Eastern Hemisphere sales only.
2. Available in only 2.8K, 4.2K, and 8.0K, 155°F (68°C) and 200°F (93°C); requires longer lead time to manufacture.

TABLE F
SERIES TY-FRB PENDENT AND UPRIGHT SPRINKLERS
PART NUMBER SELECTION

Limited Warranty

For warranty terms and conditions, visit www.tyco-fire.com.

Ordering Procedure

Contact your local distributor for availability. When placing an order, indicate the full product name and Part Number (P/N).

Sprinkler Assemblies with NPT Thread Connections

Specify: Series TY-FRB (Specify SIN), (specify K-factor), (specify Pendent or Upright) Sprinkler (specify) temperature rating, (specify) finish or coating, P/N (specify from Table F)

Recessed Escutcheon

Specify: Style (10, 20, 30, or 40) Recessed Escutcheon with (specify*) finish, P/N (specify*)

* Refer to technical data sheet TFP770

Sprinkler Wrench

Specify: W-Type 6 Sprinkler Wrench, P/N 56-000-6-387

Specify: W-Type 7 Sprinkler Wrench, P/N 56-850-4-001



Worldwide
Contacts

www.tyco-fire.com

TFP171 Change History Appendix

ISSUE DATE	NOTES
12-22	Page 9, Table C, added note to footnote 4, removing LPCB Approved from Pendent and Recessed Pendent TY3231 286°F (141°C) temperature rating; Page 9, Table C, removed note Approved by the Loss Prevention Certification Board (LPCB Ref. No. 094a/06) as Quick Response Sprinklers, formerly footnote 7.
09-22	Page 1, added QR code and URL to allow convenient access to electronic version from printed document; Page 2, Approvals sub-section, Page 9, Table C, Page 10, Table D, TY3231, TY4131, TY4231, TY3131 sprinkler only, added EAC Approved; Page 12, changed corporate address and telephone number to 1467 Elmwood Avenue, Cranston, RI 02910 Telephone +1-401-781-8220, formerly 1400 Pennbrook Parkway, Lansdale, PA 19446 Telephone +1-215-362-0700.
12-20	Changed temperature rating of TY4131 8.0K Upright Sprinkler with Blue bulb liquid color to 286°F (141°C), formerly shown incorrectly as 200°F (93°C).
03-20	Removed LPCB Approval from TY3131 5.6K Upright Sprinkler.
07-18	Updated Tyco® branding and document format; Added Johnson Controls copyright; Added disclaimer stating specifications and information subject to change without notice; Added reference to Regulatory and Health Warning Technical Data Sheet TFP2300; Added Poly-Stainless Grey Aluminum finish, formerly described in Technical Data Sheet TFP682.
09-17	Added statement prohibiting sprinklers featuring K-factors greater than 5.6 and 1/2 in. NPT thread size from installation in new construction, explicitly for retrofit applications only.
11-15	Clarified finishes and polyester coating.
10-13	Removed Eastern Hemisphere Sales Only limitation from TY4831 and TY4931 upright and pendent 8.0K x 1/2 in. NPT sprinklers; Added torque requirements for 3/4 in. NPT sprinklers.
03-13	Updated and standardized RAL color finishes.
07-10	Added higher temperature rating for TY3231 and TY4241; Clarified LPCB certification; Corrected SIN numbers in Table C for 2.8K and 4.2K sprinklers; Simplified footnotes in Tables A and B; Clarified Installation and Care and Maintenance sections.
08-07	Added FM Approval for 5.6K White Coated Sprinkler with Style 20 Recessed Escutcheon application.
03-07	Added 8.0K 1/2 in. NPT Pendent and Upright Sprinklers.
04-06	Added statement indicating TY3131 and TY3231 are UL and C-UL Listed for 250 psi (17,2 bar) maximum working pressure.
07-04	Added reference to Installer Warning data sheet TFP700; Added LPCB Reference Numbers; Added option for White RAL9010 for Eastern Hemisphere sales.
04-03	Added 4.2K sprinkler; Added recessed option for 2.8K pendent sprinkler.
01-03	Added new Tyco Fire & Building Products masthead.
09-02	New Technical Data Sheet TFP171 describes Series TY-FRB Upright, Pendent, and Recessed Pendent Sprinklers.

SECTION 4

MISCELLANEOUS

Victaulic® VicFlex™ Sprinkler Fittings

Series AH2 and AH2-CC Braided Flexible Hoses



Series AH2



Series AH2-CC

1.0 PRODUCT DESCRIPTION

Available Sizes by Component

- **Series AH2 1"/DN25 Nominal ID Braided Hose:** 31, 36, 48, 60, 72"/790, 915, 1220, 1525, 1830 mm.
Note: length includes adapter nipple and 5.75"/140 mm straight reducer.
- **Series AH2-CC 1"/DN25 Nominal ID Braided Hose:** 31, 36, 48, 60, 72"/790, 915, 1220, 1525, 1830 mm.
Note: length includes captured coupling and 5.75"/140 mm straight reducer.
- **Sprinkler Reducers:**
 - **Sprinkler Connections:** ½ and ¾"/15 and 20 mm
 - **Straight Lengths:** 5.75, 9, 13"/140, 230, 330 mm
 - **90° Elbows:**
 - Short (typically used with concealed sprinklers)
 - Long (typically used with recessed pendent sprinklers)
 - Low Profile Short (for use with Style AB5, AB11, AB12, ABBA and ABMM Bracket)
 - Low Profile Long (for use with Style AB5, AB11, AB12, ABBA and ABMM Bracket)
- **Inlet Connections:**
 - 1"/25 mm Grooved IGS
 - 1"/25 mm NPT or BSPT adapter nipples for attaching to pipe and fittings outlined in NFPA standards.
 - ¾"/20 mm NPT or BSPT adapter nipples available for VdS.
 - 1 ¼"/ 32 mm BSPT adapter nipples available for LPCB.

ALWAYS REFER TO ANY NOTIFICATIONS AT THE END OF THIS DOCUMENT REGARDING PRODUCT INSTALLATION, MAINTENANCE OR SUPPORT.

System No.		Location	
Submitted By		Date	

Spec Section		Paragraph	
Approved		Date	

1.0 PRODUCT DESCRIPTION (Continued)

• Brackets:

- Style AB1 for suspended and hard-lid ceilings and sidewalls, allows installation before most ceiling tiles in place
- Style AB2 for suspended and hard-lid ceilings and sidewalls, allows for vertical sprinkler adjustment, and installation before most ceiling tiles in place
- Style AB3 for surface mount applications, wood, metal and block walls, or ceilings
- Style AB4 for hard-lid ceilings with hat furring channel grid systems, allows for vertical sprinkler adjustment
- Style AB5 for hard-lid ceilings and sidewalls, allows for vertical sprinkler adjustment
- Style AB7 for suspended and hard-lid ceilings
- Style AB7 Adjustable for suspended and hard-lid ceilings
- Style AB8 for hard-lid ceilings with CD 60/27 profile metal studs (regionally available)
- Style AB9 for hard-lid ceilings with hat furring channel grid systems
- Style AB10 for Armstrong® TechZone™ ceilings
- Style AB11 for lay-in panel suspended t-grid ceilings or drywall suspended t-grid ceilings, allows for low profile installations (use only with 90° low profile elbows)
- Style AB12 for suspended and hard-lid ceilings, allows for vertical sprinkler adjustment, and allows for low profile installation down to 4"/100mm.
- Style ABBA bracket for suspended, exposed, and hard-lid ceilings
- Style ABMM bracket for surface mount and stand off-mount applications, wood, metal and block walls, or ceilings and hard-lid ceilings

Maximum Working Temperature

- 225°F/107°C

Maximum Working Pressure

- 200 psi/1375 kPa (FM Approval)
- 175 psi/1206 kPa (cULus Listed)
- 1600 kPa/232 psi (VdS/LPCB Approved)
- 1.4 MPa (CCCf Approved)

Connections

- To adapter nipple (inlet) via
 - 1"/25.4 mm Grooved IGS
 - 1"/25.4 mm NPT or BSPT male thread
 - ¾"/20 mm BSPT male thread (VdS only)
 - 1 ¼"/32 mm BSPT male thread (LPCB only)
- To sprinkler head (outlet) via ½" or ¾"/15 mm or 20 mm

Minimum Bend Radius

- 7"/178 mm (FM/CCCf Approval)
- 2"/51 mm (cULus Listed)
- 3"/76.2 mm (VdS/LPCB Approved)

Maximum Allowable Sprinkler K-Factors

- FM (½"/15 mm reducer) K5.6/8,1 (S.I.), (¾"/20 mm reducer) K14.0/20,2 (S.I.)
- cULus (½"/15 mm reducer) K8.0/11,5 (S.I.), (¾"/20 mm reducer) K14.0/20,2 (S.I.)
- VdS/LPCB (½"/15 mm reducer) K5.6/8,1 (S.I.), (¾"/20 mm reducer) K8.0/11,5 (S.I.)

2.0 CERTIFICATION/LISTINGS



NOTE

- The *VicFlex* Series AH2 Hose has been tested and evaluated by Spears® for acceptable use with Spears® CPVC Products and is therefore covered under the Spears® FlameGaurd® Installer Protection Plan.

3.0 SPECIFICATIONS – MATERIAL

Series AH2

- Flexible Hose:** 300-series Stainless Steel
- Collar/Weld Fitting:** 300-series Stainless Steel
- Gasket Seal:** Victaulic EPDM
- Isolation Ring:** Nylon
- Nut and Nipple:** Carbon Steel, Zinc Plated
- Reducer (½"/15 mm or ¾"/20 mm):** Carbon Steel, Zinc-Plated
- Low Profile Elbows:** Ductile Iron, Zinc-Plated

Brackets: Carbon Steel, Zinc-Plated

Series AH2-CC

- Flexible Hose:** 300-series Stainless Steel
- Collar/Weld Fitting:** 300-series Stainless Steel
- Gasket Seal:** Victaulic EPDM
- Isolation Ring:** Nylon
- Coupling Retainer Ring:** Polyethylene
- Nut and Nipple:** Carbon Steel, Zinc Plated
- Reducer (½"/15 mm or ¾"/20 mm):** Carbon Steel, Zinc-Plated
- Housing:** Ductile iron conforming to ASTM A 536, Grade 65-45-12. Ductile iron conforming to ASTM A 395, Grade 65-45-15, is available upon special request.

Coupling Housing Coating:

- Orange enamel (North America, Asia Pacific).
- Red enamel (Europe).
- Hot dipped galvanized.

Gasket:¹

- Grade "E" EPDM (Type A)**


FireLock EZ products have been Listed by Underwriters Laboratories Inc., Underwriters Laboratories of Canada Limited, and Approved by Factory Mutual Research for wet and dry (oil free air) sprinkler services within the rated working pressure.

¹ Services listed are General Service Guidelines only. It should be noted that there are services for which these gaskets are not compatible. Reference should always be made to the latest [Victaulic Gasket Selection Guide](#) for specific gasket service guidelines and for a listing of services which are not compatible.

- Bolts/Nut:** Zinc electroplated carbon steel, trackhead meeting the physical and chemical requirements of ASTM A 449 and physical requirements of ASTM A 183.
- Linkage:** CrMo Alloy Steel zinc electroplated per ASTM B633 Zn/Fe 5, Type III Finish

4.0 DIMENSIONS

Product Details - Series AH2 Braided Hose

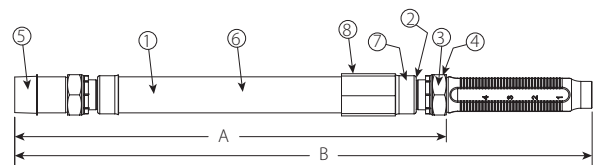


Item	Description
1	Flexible Hose
2	Isolation Ring
3	Gasket
4	Nut
5	Adapter Nipple
6	Braid
7	Collar/Weld Fitting
8	Sleeve

Hose Length Dimensions

Hose Length inches mm	A inches mm	B inches mm
31/790	25.3/641	31/790
36/915	31.3/794	36/915
48/1219	42.3/1073	48/1220
60/1525	54.3/1378	60/1525
72/1830	66.3/1683	72/1830

Series AH2-CC Braided Hose

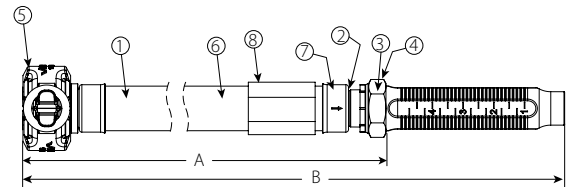

Item	Description
1	Flexible Hose
2	Isolation Ring
3	Gasket
4	Nut
5	Captured Coupling
6	Braid
7	Collar/Weld Fitting
8	Sleeve

Hose Length inches mm	A inches mm	B inches mm
31/790	24.5/622	29.8/757
36/915	29.5/749	34.8/884
48/1219	41.5/1054	46.8/1189
60/1525	53.5/1359	58.8/1494
72/1830	65.5/1664	70.8/1798

4.0 DIMENSIONS (Continued)

Standard Reducer




5.75"/140 mm straight reducer


Optional Reducers




9.0"/229 mm straight reducer



13.0"/330 mm straight reducer

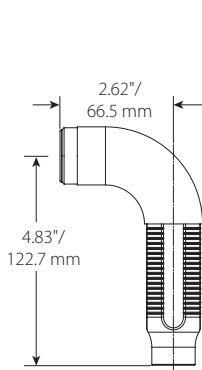

Short 90° elbow reducer

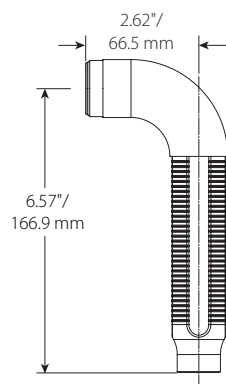


Long 90° elbow reducer


NOTE

- The Short 90° elbow reducer is typically used with concealed sprinklers while the longer 90 elbow is typically used in the installation of recessed pendent sprinklers.
- FM/VdS Approved only.

Low Profile

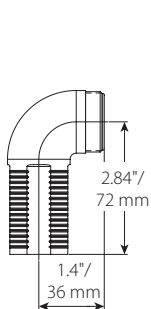

Short 90° elbow reducer

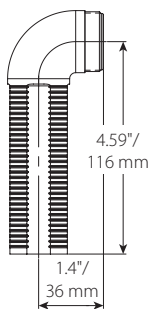

Long 90° elbow reducer

NOTE

- Style AB11: When low profiles elbows are used with the Style AB11 bracket, the Low Profile Short Elbow is typically used with concealed sprinklers while the Low Profile Long Elbow is typically used in the installation of recessed pendent sprinklers.

4.1 DIMENSIONS

VicFlex Brackets


Style AB1

- Suspended Ceilings
- Hard-Lid Ceilings (FM Only)

Item	Description
1	24"/610 mm or 48"/1219 mm Square Bar
2	Patented Center Bracket
3	End Bracket

NOTE

- Both sizes FM/VdS/LPCB Approved, cULus listed

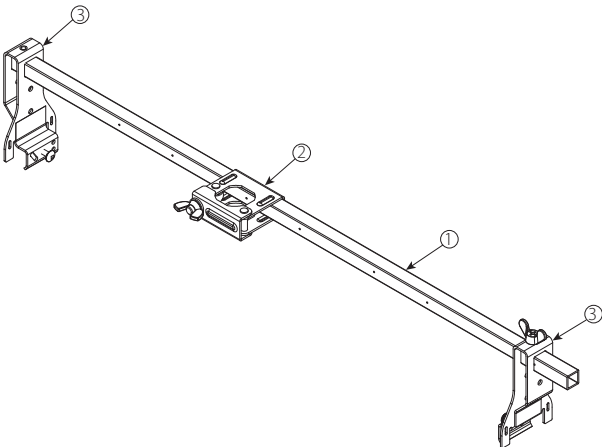


Style AB2

- Suspended Ceilings
- Hard-Lid Ceilings

Item	Description
1	24"/610 mm or 48"/1219 mm Square Bar
2	Patented Vertically Adjustable Center Bracket
3	End Bracket


NOTE

- Both sizes FM/VdS/LPCB Approved, cULus listed

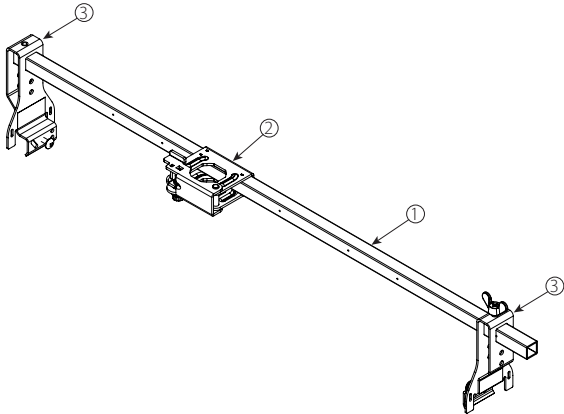

Style AB3

- Surface Mount Applications
- FM/LPCB Approved

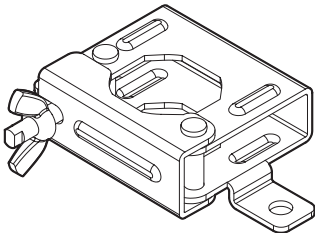

4.2 DIMENSIONS

VicFlex Brackets


Style AB4

- Hard-Lid Ceilings with Hat furring channel grid system

Item	Description
1	24"/610 mm or 48"/1219 mm Square Bar
2	Patented Vertically Adjustable Center Bracket
3	End Bracket for Hat Furring Channel

NOTE

- Both sizes FM/VdS/LPCB Approved, cULus listed.

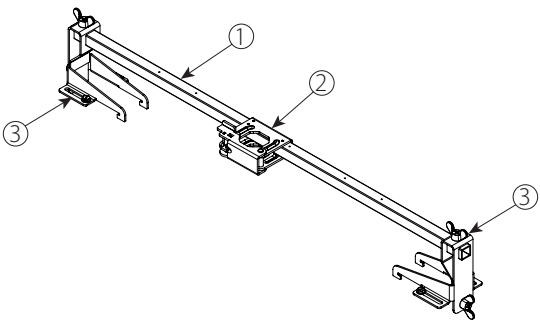


Style AB5

- Hard-Lid Ceilings

Item	Description
1	24"/610 mm or 48"/1219 mm Square Bar
2	Patented Vertically Adjustable Center Bracket
3	End Bracket

NOTE

- Both sizes FM/VdS/LPCB Approved, cULus listed.

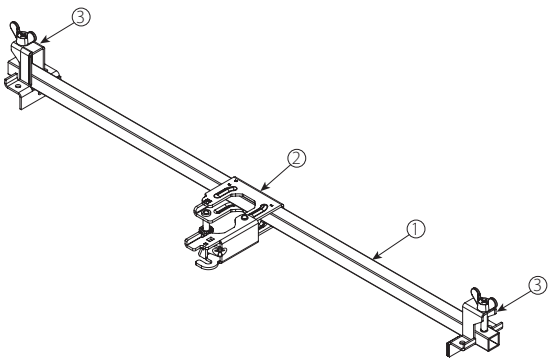


Style AB7

- Suspended Ceilings
- Hard-Lid Ceilings

Item	Description
1	24"/610 mm or 48"/1219 mm Square Bar
2	Patented 1-Bee2® Center Bracket
3	End Bracket

NOTE

- Both sizes FM/VdS/LPCB Approved.

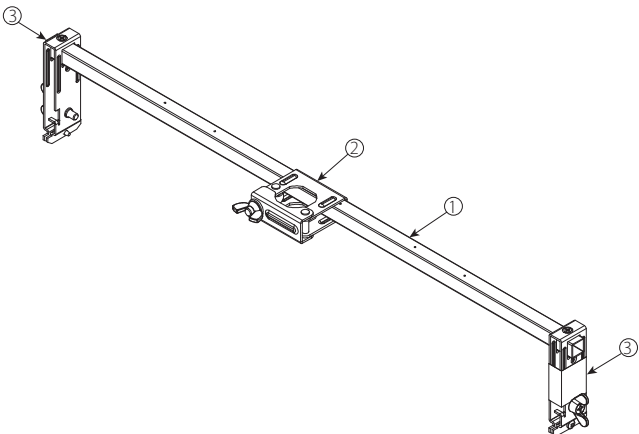


Style AB7 Adjustable

- Suspended Ceilings
- Hard-Lid Ceilings

Item	Description
1	700 mm or 1400 mm Square Bar
2	Patented 1-Bee2® Center Bracket
3	End Bracket (adjustable)

NOTE

- Both sizes FM/VdS/LPCB Approved.

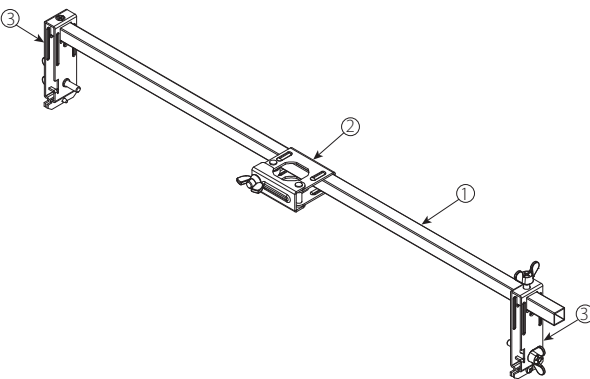

4.3 DIMENSIONS

VicFlex Brackets


Style AB8

- Hard-Lid Ceilings

Item	Description
1	700 mm or 1400 mm Square Bar
2	Patented Vertically Adjustable Center Bracket
3	End Bracket

NOTE

- Both sizes FM/VdS/LPCB Approved.

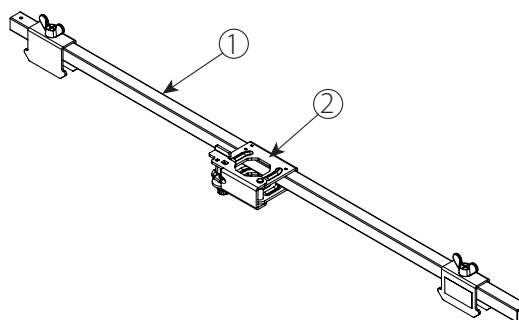


Style AB10

- Suspended ceilings
- Armstrong® TechZone™

Item	Description
1	6"/152 mm Square Bar
2	Patented 1-Bee2® Center Bracket
3	End Bracket

NOTE

- FM/VdS/LPCB Approved, cULus listed.




Style AB11

- Suspended ceilings
- Hard-Lid ceilings

Item	Description
1	24"/610 mm or 48"/1219 mm Square Bar
2	Patented 1-Bee2® Center Bracket
3	End Bracket

NOTE

- FM/VdS Approved, cULus listed.

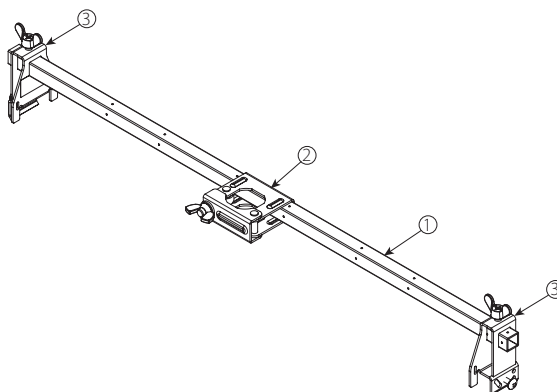


Style AB12

- Suspended ceilings
- Hard-Lid ceilings

Item	Description
1	Style AB12 Bracket Body
2	#2 Square Drive Set Screw

NOTE

- FM/VdS Approved.

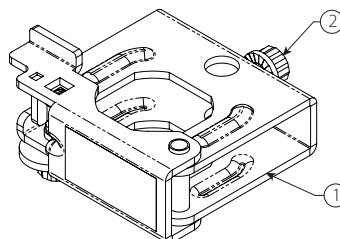


4.3 DIMENSIONS (CONTINUED)

VicFlex Brackets

Style ABBA

- Floor-above mount
- Cantilever mount
- Temporary mount in exposed ceilings


Item	Description
1	Style ABBA Mounting Plate
2	Style ABBA Square Bar
3	Cap Screw, Serated Flange, M6 x 1 x 20, T25 Torx Drive Recessed
4	Style ABMM Bracket Body
5	Cap Screw, Serated Flange, M6 x 1 x 15.24, T25 Torx Drive Recessed

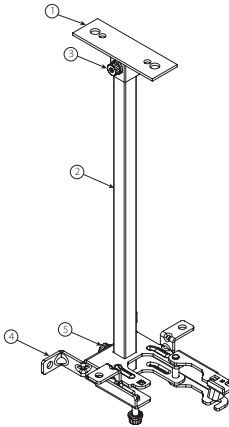

Style ABMM

- Surface mount
- Stand-off mount


Item	Description
1	Style ABMM Bracket Body
2	Cap Screw, Serated Flange, M6 x 1 x 15.24, T25 Torx Drive Recessed

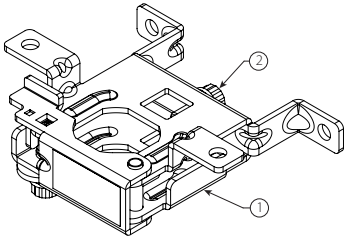

4.4 DIMENSIONS

Clearances

Series AH2 Braided Hose and Style AB1 Bracket

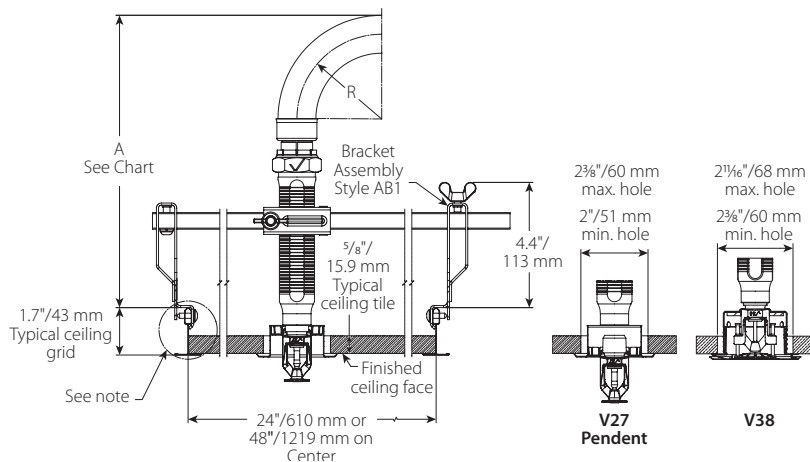

Hose Clearance Chart								
	Straight Reducer						Long Elbow	Short Elbow
	V2707 3/4" Max Recess inches mm	V3802 1/2" Max Recess inches mm	V2707 3/4" Max Recess inches mm	V3802 1/2" Max Recess inches mm	V2707 3/4" Max Recess inches mm	V3802 1/2" Max Recess inches mm	V2707 3/4" Max Recess inches mm	V3802 1/2" Max Recess inches mm
"R" Minimum Bend Radius	2.0 50		3.0 80		7.0 175		—	
"A" Minimum Required Installation Space	8.6 218	10.1 269	9.6 244	11.1 281	13.6 345	15.1 383	5.8 147	5.8 147


NOTE

- Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.

4.5 DIMENSIONS

Clearances

Series AH2 Braided Hose and Style AB2 Bracket

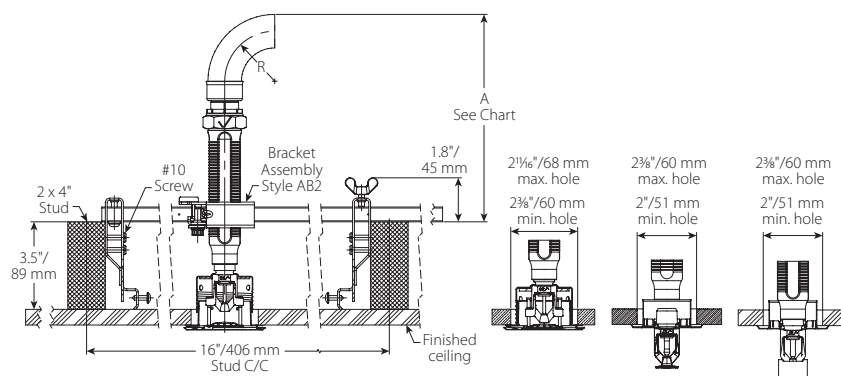

Hose Clearance Chart									
	Straight Reducer								
	V2707 3/4" 20 mm Max Recess inches mm	V3802 1/2" 13 mm Max Recess inches mm	V2709 3/4" 20 mm Sidewall inches mm	V2707 3/4" 20 mm Max Recess inches mm	V3802 1/2" 13 mm Max Recess inches mm	V2709 3/4" 20 mm Sidewall inches mm	V2707 3/4" 20 mm Max Recess inches mm	V3802 1/2" 13 mm Max Recess inches mm	V2709 3/4" 20 mm Sidewall inches mm
"R" Minimum Bend Radius	2.0 50			3.0 80			7.0 175		
"A" Minimum Required Installation Space	6.2 158	7.6 193	6.1 155	7.2 183	8.6 218	7.1 180	11.2 285	12.6 320	11.1 282

Hose Clearance Chart			
	Long Elbow		Short Elbow
	V2707 3/4" 20 mm Max Recess inches mm	V2709 3/4" 20 mm Sidewall inches mm	V3802 1/2" 13 mm Max Recess inches mm
"R" Minimum Bend Radius	-		
"A" Minimum Required Installation Space	3.3 84	3.6 91	3.3 84


NOTE

- Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.

4.6 DIMENSIONS

Clearances

Series AH2 Braided Hose and Style AB4 Bracket

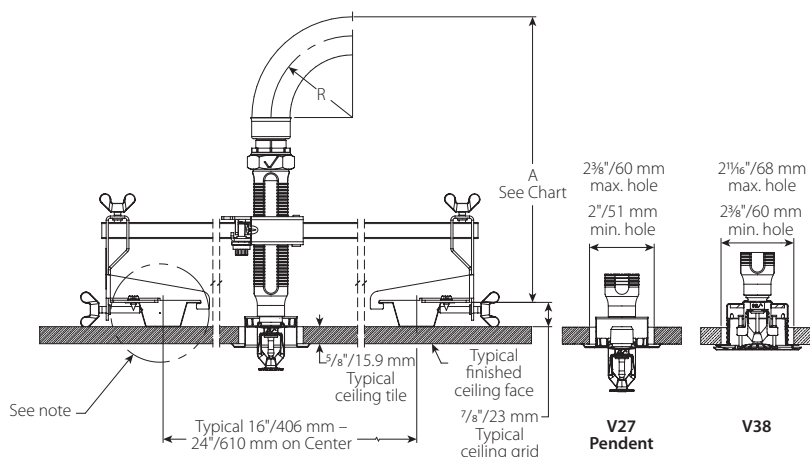

Hose Clearance Chart								
	Straight Reducer						Long Elbow	Short Elbow
	V2707 3/4" Max Recess inches mm	V3802 1/2" Max Recess inches mm	V2707 3/4" Max Recess inches mm	V3802 1/2" Max Recess inches mm	V2707 3/4" Max Recess inches mm	V3802 1/2" Max Recess inches mm	V2707 3/4" Max Recess inches mm	V3802 1/2" Max Recess inches mm
"R" Minimum Bend Radius	2.0 50	2.0 50	3.0 80	3.0 80	7.0 175	7.0 175	-	
"A" Minimum Required Installation Space	8.8 224	10.2 259	9.8 249	11.2 285	13.8 351	15.2 386	8.0 203	5.9 150


NOTE

Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.

4.7 DIMENSIONS

Clearances

Series AH2 Braided Hose and Style AB5 Bracket

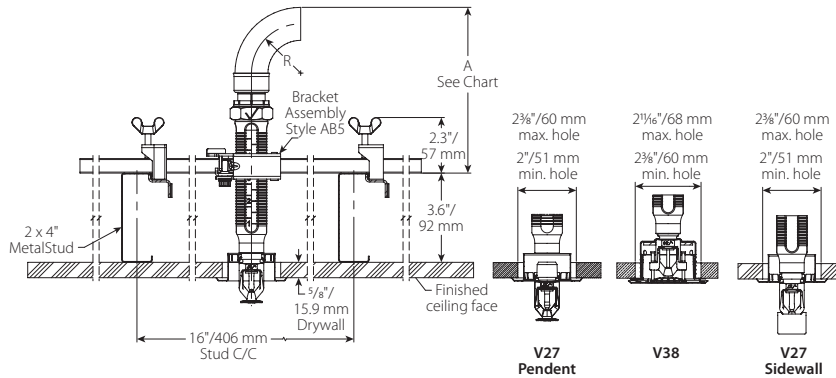

Hose Clearance Chart									
	Straight Reducer								
	V2707 3/4" 20 mm Max Recess inches mm	V3802 1/2" 13 mm Max Recess inches mm	V2709 3/4" 20 mm Sidewall inches mm	V2707 3/4" 20 mm Max Recess inches mm	V3802 1/2" 13 mm Max Recess inches mm	V2709 3/4" 20 mm Sidewall inches mm	V2707 3/4" 20 mm Max Recess inches mm	V3802 1/2" 13 mm Max Recess inches mm	V2709 3/4" 20 mm Sidewall inches mm
"R" Minimum Bend Radius	2.0 50			3.0 80			7.0 175		
"A" Minimum Required Installation Space	6.0 158	7.7 196	6.1 155	7.0 178	8.7 221	7.1 180	11.0 279	12.7 323	11.1 282

Hose Clearance Chart					
	Long Elbow			Low-Profile Long Elbow	Short Elbow
	V2707 3/4" 20 mm Max Recess inches mm	V3802 1/2" 13 mm Max Recess inches mm	V2709 3/4" 20 mm Sidewall inches mm	V3802 1/2" 13 mm Max Recess inches mm	V3802 1/2" 13 mm Max Recess inches mm
"R" Minimum Bend Radius	-				
"A" Minimum Required Installation Space	3.5 89	4.9 124	3.6 91	2.9 74	3.3 84


NOTE

- Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.

4.8 DIMENSIONS

Clearances

Series AH2 Braided Hose and Style AB11 Bracket (LOW PROFILE SOLUTION)

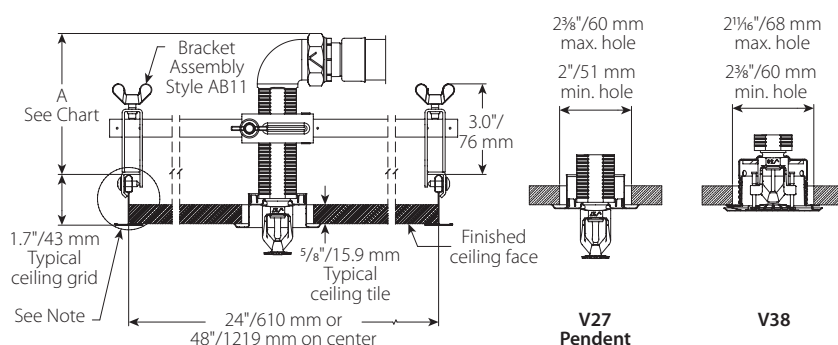

Hose Clearance Chart		
	Low-Profile Long Elbow	Low-Profile Short Elbow
	V2707 ¾" 20 mm Max Recess inches mm	V3802 ½" 13 mm Max Recess inches mm
"A" Minimum Required Installation Space	4.0 102	3.9 99

NOTE


- Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.

4.9 DIMENSIONS

Clearances


Style AB12 and ABBA Bracket

Suspended Ceiling Grid with Recessed Sprinkler with Low Profile Short Elbow

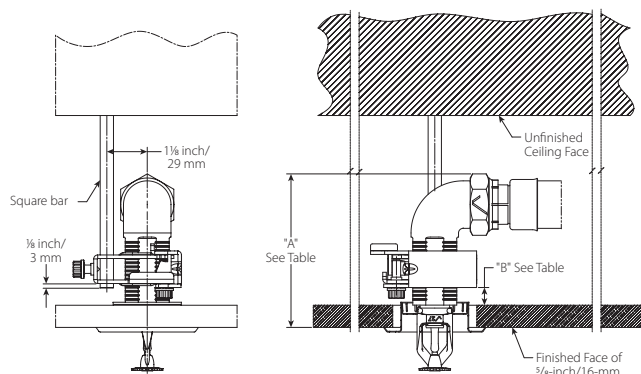

V2707 1/2" / 12.7 mm MAX. RECESS

Suspended Ceiling Grid with Recessed Sprinkler and Straight 5.75"/140 mm Reducer

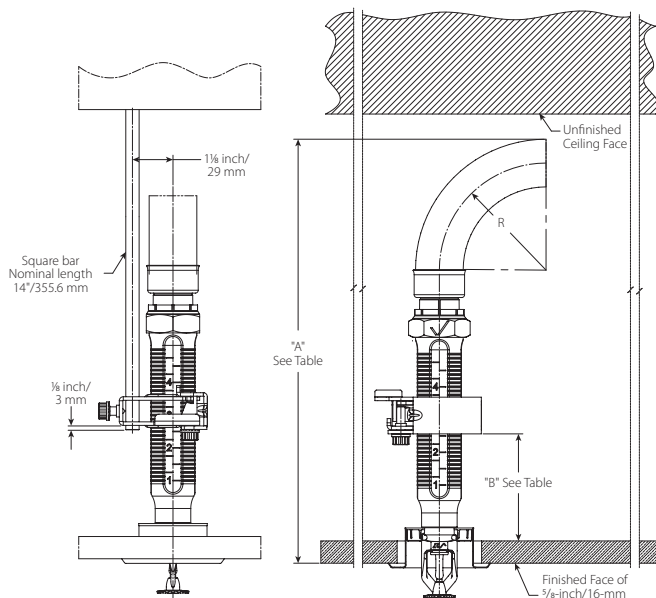


V2707 3/4" / 19 mm MAX. RECESS

Dimension		Low Profile Short Elbow		Low Profile Long Elbow		Standard Short Elbow		Standard Long Elbow		Standard Straight Reducer	
		3/4" / 19 mm Recessed*	Concealed	3/4" / 19 mm Recessed	Concealed	3/4" / 19 mm Recessed	Concealed	3/4" / 19 mm Recessed	Concealed	3/4" / 19 mm Recessed	Concealed
		inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm
A	Minimum Required Installation Space	4.0 101.6	5.5 139.7	5.6 142.2	7.2 182.9	5.9 149.9	7.5 190.5	7.7 195.6	9.3 236.2	15.0 381.0	16.6 421.6
B	Distance from Top of Typical Ceiling Tile to Bottom of Gate	0.5 12.7	2.0 50.8	1.5 38.1	1.5 38.1	1.5 38.1	1.5 38.1	3.0 76.2	3.0 76.2	3.0 76.2	3.0 76.2

* Adjustability will be limited

Style ABMM Bracket

Stand-off Dimensions

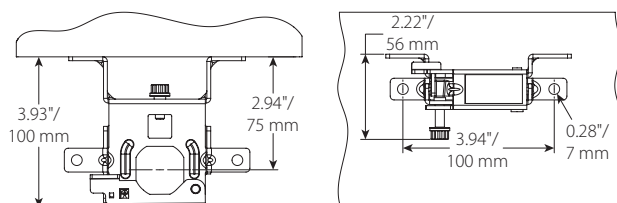


4.10 DIMENSIONS

Clearances

Style AB3 and ABMM Bracket

Surface Mount Application with Recessed Sprinkler

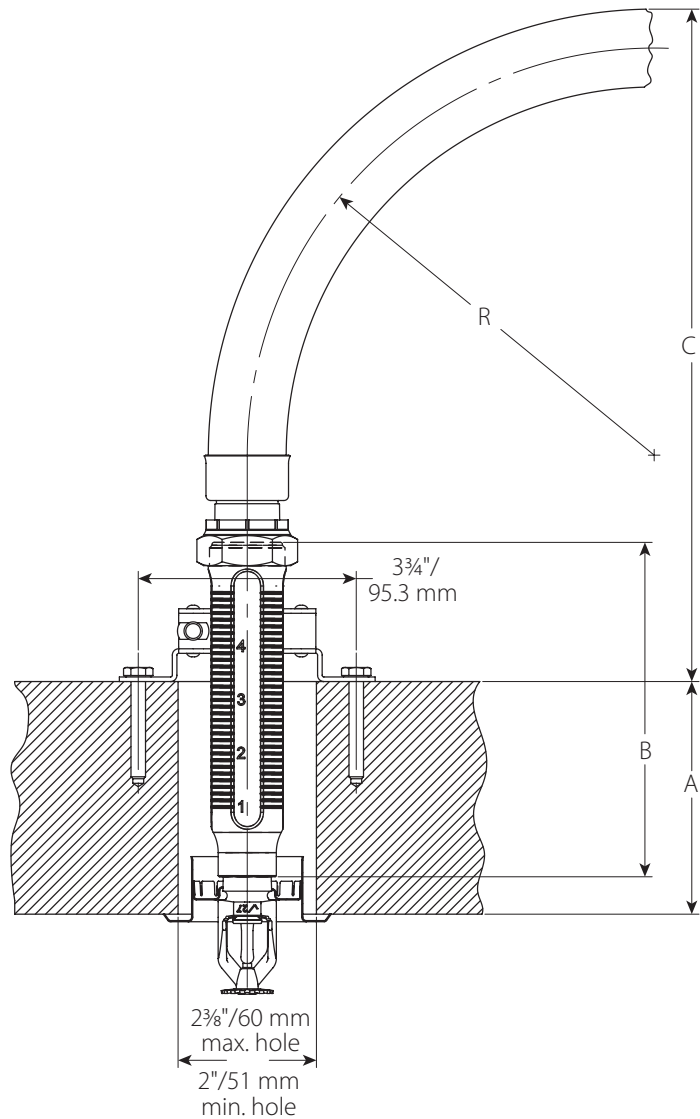

Hose Clearances																				
Dimension	inches mm			inches mm			inches mm		inches mm	inches mm	inches mm			inches mm			inches mm		inches mm	inches mm
Wall Thickness "A"	2 50			4 100			6 150		8 200	10 250	2 50			4 100			6 150		8 200	10 250
Outlet Length "B"	5.75 146.1	9 228.6	13 330.2	5.75 146.1	9 228.6	13 330.2	9 228.6	13 330.2	13 330.2	13 330.2	5.75 146.1	9 228.6	13 330.2	5.75 146.1	9 228.6	13 330.2	9 228.6	13 330.2	13 330.2	13 330.2
Hose Clearance "C"	11.6 294	14.8 376	18.8 478	9.6 243	12.8 325	16.8 427	10.8 275	14.8 376	12.8 325	10.8 275	12.6 319	15.8 402	19.8 503	10.6 268	13.8 351	17.8 452	11.8 300	15.8 402	13.8 351	11.8 300
Bend Radius "R"	7 175										8 200									

NOTE

- Variations of ceiling grids, sprinkler heads, brackets, and hoses are permitted but may result in clearance differences from the figures above.

5.0 PERFORMANCE – FRICTION LOSS DATA



Series AH2 and AH2-CC Braided Hoses with Straight 5.75"/140 mm Reducers Style AB1, AB2, AB4, AB5 and AB10 Brackets

inches/mm	inches/mm/type	Equivalent Length of 1"/33.7 mm Sch. 40 Pipe (C=120)	Maximum Number of 90° Bends at 2"/51 mm Bend Radius
31/790	1/2"/15/Straight	16/4.9	4
	3/4"/20/Straight	17/5.2	4
36/915	1/2"/15/Straight	21/6.4	5
	3/4"/20/Straight	23/7.0	5
48/1220	1/2"/15/Straight	32/9.8	8
	3/4"/20/Straight	37/11.3	8
60/1525	1/2"/15/Straight	46/14.0	10
	3/4"/20/Straight	46/14.0	10
72/1830	1/2"/15/Straight	55/16.8	12
	3/4"/20/Straight	53/16.2	12



Series AH2 and AH2-CC Braided Hose with 90° Low Profile Elbows Style AB11 VicFlex Bracket

inches/mm	inches/mm	Equivalent Length of 1"/33.7 mm Sch. 40 Pipe	Maximum Number of 90° Bends at 2"/51 mm Bend Radius
31/790	1/2"/15	24/7.3	4
	3/4"/20	24/7.3	4
36/915	1/2"/15	26/7.9	5
	3/4"/20	28/8.5	5
48/1220	1/2"/15	43/13.1	8
	3/4"/20	42/12.8	8
60/1525	1/2"/15	49/14.9	10
	3/4"/20	50/15.2	10
72/1830	1/2"/15	65/19.8	12
	3/4"/20	63/19.2	12

5.0 PERFORMANCE – FRICTION LOSS DATA (CONTINUED)

Series AH2 and AH2-CC Braided Hoses Equivalent Length Design Guide

Equivalent length values at various numbers of 90 degree bends at 2"/51 mm center line bend radius

Length of Stainless Steel Flexible Hose inches/ mm	Outlet Size inches/ mm	1 Bend feet/ meters	2 Bends feet/ meters	3 Bends feet/ meters	4 Bends feet/ meters	5 Bends feet/ meters	6 Bends feet/ meters	7 Bends feet/ meters	8 Bends feet/ meters	9 Bends feet/ meters	10 Bends feet/ meters	11 Bends feet/ meters	12 Bends feet/ meters
31/790	½"/15	8.5/2.6	11.0/3.4	13.0/4.0	16.0/4.9	N.A	N.A	N.A	N.A	N.A	N.A	N.A	N.A
	¾"/20	10.0/3.0	12.5/3.8	14.0/4.3	17.0/5.2	N.A	N.A	N.A	N.A	N.A	N.A	N.A	N.A
36/915	½"/15	13.5/4.1	16.0/4.9	18.0/5.5	19.0/5.8	21.0/6.4	N.A	N.A	N.A	N.A	N.A	N.A	N.A
	¾"/20	14.0/4.3	17.0/5.2	19.5/5.9	20.0/6.1	23.0/7.0	N.A	N.A	N.A	N.A	N.A	N.A	N.A
48/1220	½"/15	15.5/4.7	17.0/5.2	19.5/5.9	20.0/6.1	21.0/6.4	22.0/6.7	28.0/8.5	32.0/9.8	N.A	N.A	N.A	N.A
	¾"/20	17.0/5.2	19.0/5.8	21.5/6.6	24.5/7.5	26.0/7.9	27.0/8.2	30.0/9.1	37.0/11.3	N.A	N.A	N.A	N.A
60/1525	½"/15	21.5/6.6	24.0/7.3	27.0/8.2	28.5/8.7	30.0/9.1	31.0/9.4	37.0/11.3	42.0/12.8	44.0/13.4	46.0/14.0	N.A	N.A
	¾"/20	23.0/7.0	24.0/7.3	28.0/8.5	29.5/9.0	30.5/9.3	31.0/9.4	38.0/11.6	42.0/12.8	44.0/13.4	46.0/14.0	N.A	N.A
72/1830	½"/15	30.0/9.1	32.0/9.8	36.5/11.1	37.5/11.4	40.5/12.5	41.0/12.8	42.0/12.8	46.0/14.0	49.0/14.9	52.0/15.8	54.0/16.5	55.0/16.8
	¾"/20	32.0/9.8	32.5/9.9	35.0/10.7	35.5/10.8	40.0/12.3	40.5/12.3	41.0/12.5	46.0/14.0	50.0/15.2	51.0/15.5	52.0/15.8	53.0/16.2

NOTES:

- Values for use with 5.75"/140mm straight reducers.

How to use this Design Guide:

- For some systems, it may be advantageous for the designer to calculate the system hydraulics using shorter equivalent lengths associated with fewer than the maximum allowable number of bends. In this case, the designer may select a design number of bends for the job and use the associated equivalent length from the design guide to determine the system hydraulics.
- It is possible that the actual installed condition of some of the flexible drops may have more bends than the designer selected. When this happens, the design guide may be used to find equivalent lengths based on the actual installed number of bends for particular sprinkler installations. The system hydraulics can be recalculated using actual equivalent lengths to verify the performance of the system.

5.1 PERFORMANCE – FRICTION LOSS DATA



Series AH2 and AH2-CC Braided Hoses

Style AB1, AB2, AB3, AB4, AB5, AB7, AB7 Adj., AB8, AB10, AB12, ABBA and ABMM *VicFlex* Brackets

Length of Stainless Steel Flexible Hose	K-Factor	Outlet Size	Equivalent Length of 1"/33.7 mm Sch. 40 Pipe	Maximum Number of 90° Bends at 7"/178 mm Bend Radius
inches/mm	Imperial/S.I.	inches/mm/type	feet/meters	
31/790	5.6/8.1	½"/15/Straight	13.8/4.2	2
		½"/15/90° Elbow	23.5/7.1	
36/915	5.6/8.1	½"/15/Straight	16.6/5.1	2
		½"/15/90° Elbow	25.6/7.8	
48/1220	5.6/8.1	½"/15/Straight	23.4/7.1	3
		½"/15/90° Elbow	30.7/9.3	
60/1525	5.6/8.1	½"/15/Straight	30.2/9.2	4
		½"/15/90° Elbow	35.9/10.9	
72/1830	5.6/8.1	½"/15/Straight	37.0/11.3	4
		½"/15/90° Elbow	41.1/12.5	
31/790	8.0/11.5	¾"/20/Straight	16.8/5.1	2
		¾"/20/90° Elbow	16.8/5.1	
36/915	8.0/11.5	¾"/20/Straight	20/6.0	2
		¾"/20/90° Elbow	19.7/6.0	
48/1220	8.0/11.5	¾"/20/Straight	27.8/8.4	3
		¾"/20/90° Elbow	26.6/8.1	
60/1525	8.0/11.5	¾"/20/Straight	35.7/10.9	4
		¾"/20/90° Elbow	33.6/10.2	
72/1830	8.0/11.5	¾"/20/Straight	43.5/13.2	4
		¾"/20/90° Elbow	40.6/12.2	
31/790	11.2/16.1	¾"/20/Straight	16.5/5.0	2
		¾"/20/90° Elbow	17.8/5.4	
36/915	11.2/16.1	¾"/20/Straight	19.5/5.9	2
		¾"/20/90° Elbow	20.7/6.3	
48/1220	11.2/16.1	¾"/20/Straight	26.7/8.1	3
		¾"/20/90° Elbow	27.9/8.5	
60/1525	11.2/16.1	¾"/20/Straight	33.9/10.3	4
		¾"/20/90° Elbow	35/10.7	
72/1830	11.2/16.1	¾"/20/Straight	41.3/12.5	4
		¾"/20/90° Elbow	42.2/12.8	
31/790	14.0/20.2	¾"/20/Straight	14.9/4.5	2
		¾"/20/90° Elbow	15.5/4.72	
36/915	14.0/20.2	¾"/20/Straight	19.4/5.9	2
		¾"/20/90° Elbow	19.6/5.9	
48/1220	14.0/20.2	¾"/20/Straight	30.3/9.2	3
		¾"/20/90° Elbow	29.5/8.9	
60/1525	14.0/20.2	¾"/20/Straight	33.9/10.3	4
		¾"/20/90° Elbow	34.1/10.4	
72/1830	14.0/20.2	¾"/20/Straight	37.5/11.4	4
		¾"/20/90° Elbow	38.6/11.7	

FM NOTES:

- The Series AH2 hose has been tested and Approved by FM Global for use in wet, dry and preaction systems per NFPA 13, 13R, and 13D and FM data sheets 2-0, 2-5, and 2-8. FM 1637 standard for safety include, but are not limited to, pressure cycling, corrosion resistance, flow characteristics, vibration resistance, leakage, mechanical and hydrostatic strength.
- EXAMPLE: A 48-inch hose installed with two 30° bends and two 90° bends is permitted and considered equivalent to the data in the table shown above. In this example, the total number of degrees is 240°, which is less than the allowable 270°.

5.2 PERFORMANCE – FRICTION LOSS DATA



Series AH2 Braided Hose with 90° Low Profile Elbows Style AB5, AB11, AB12, ABBA and ABMM *VicFlex* Bracket

Length of Stainless Steel Flexible Hose	K-Factor	Outlet Size	Equivalent Length of 1"/33.7mm Sch. 40 Pipe	Maximum Number of 90° Bends at 7"/178mm Bend Radius
inches/mm	Imperial/S.I.	inches/mm	feet/meters	
31/790	5.6/8.1	½" /15	13.7/4.2	2
36/915	5.6/8.1	½" /15	17.0/5.2	2
48/1220	5.6/8.1	½" /15	25.0/7.6	3
60/1525	5.6/8.1	½" /15	33.0/10.1	4
72/1830	5.6/8.1	½" /15	41.1/12.5	4
31/790	8.0/11.5	¾" /20	13.6/4.14	2
36/915	8.0/11.5	¾" /20	16.9/5.2	2
48/1220	8.0/11.5	¾" /20	27.8/8.5	3
60/1525	8.0/11.5	¾" /20	32.6/9.9	4
72/1830	8.0/11.5	¾" /20	40.6/12.4	4
31/790	11.2/16.1	¾" /20	13.7/4.2	2
36/915	11.2/16.1	¾" /20	17.0/5.2	2
48/1220	11.2/16.1	¾" /20	24.9/7.6	3
60/1525	11.2/16.1	¾" /20	32.9/10.0	4
72/1830	11.2/16.1	¾" /20	40.9/12.5	4
31/790	14.0/20.2	¾" /20	13.5/4.1	2
36/915	14.0/20.2	¾" /20	16.8/5.1	2
48/1220	14.0/20.2	¾" /20	24.7/7.5	3
60/1525	14.0/20.2	¾" /20	32.7/9.9	4
72/1830	14.0/20.2	¾" /20	40.7/12.4	4

FM NOTES:

- The Series AH2 hose has been tested and Approved by FM Global for use in wet, dry and preaction systems per NFPA 13, 13R, and 13D and FM data sheets 2-0, 2-5, and 2-8. FM 1637 standard for safety include, but are not limited to, pressure cycling, corrosion resistance, flow characteristics, vibration resistance, leakage, mechanical and hydrostatic strength.
- EXAMPLE: A 48-inch hose installed with two 30° bends and two 90° bends is permitted and considered equivalent to the data in the table shown above. In this example, the total number of degrees is 240°, which is less than the allowable 270°.

5.3 PERFORMANCE – FRICTION LOSS DATA



Series AH2 and AH2-CC Braided Hose Style AB1, AB2, AB4, AB5, AB7, AB7 Adj., AB8, AB10, AB11 and AB12 Brackets

Length of Stainless Steel Flexible Hose	Outlet Size	Equivalent Length of steel pipe according to EN 10255 DN 25 (33,7 x 3,25)	Maximum Number of 90° Bends at 3"/76.2mm Bend Radius
mm/inches	mm/inches	meters/feet	meters/feet
31/790	15 mm/1/2"	5.5/18.0	3
	20 mm/3/4"		
36/915	15 mm/1/2"	6.4/21.0	3
	20 mm/3/4"		
48/1220	15 mm/1/2"	8.5/27.9	3
	20 mm/3/4"		
60/1525	15 mm/1/2"	10.7/35.1	4
	20 mm/3/4"		
72/1830	15 mm/1/2"	12.8/42.0	4
	20 mm/3/4"		

VDS CEILING MANUFACTURERS LIST

AB1, AB2, AB7, AB10, AB11 AB4

1. AMF
2. Armstrong
3. Chicago Metallic
4. Dipling
5. Durlum
6. Geipel
7. Gema-Armstrong
8. Hilti
9. Knauf
10. Lafarge
11. Linder
12. Odenwald
13. Richter
14. Rigips
15. Rockfon Pagos
16. Suckow & Fischer
17. USG Donn

No specific approval

AB5, AB8

1. Hilti
2. Knauf
3. Lafarge
4. Lindner
5. Rigips



Series AH2 and AH2-CC Braided Hose Style AB1, AB2, AB3, AB4, AB5, AB7, AB8, and AB10 Brackets

Length of Stainless Steel Flexible Hose	Outlet Size	Equivalent Length of steel pipe according to EN 10255 DN 25 (33,7 x 3,25)	Maximum Number of 90° Bends at 3"/76.2mm Bend Radius
mm/inches	mm/inches/type	meters/feet	
790/31	15 mm/1/2"/Straight	1.8/6.0	2
	20 mm/3/4"/Straight		
915/36	15 mm/1/2"/Straight	3.6/11.9	3
	20 mm/3/4"/Straight		
1220/48	15 mm/1/2"/Straight	4.3/14.0	3
	20 mm/3/4"/Straight		
1525/60	15 mm/1/2"/Straight	4.1/13.6	3
	20 mm/3/4"/Straight		
1830/72	15 mm/1/2"/Straight	5.5/18.1	3
	20 mm/3/4"/Straight		



Series AH2 Braided Hose Style AB1, AB2, AB3, AB4, AB5, AB7, AB8, AB10 and AB12 Brackets

Length of Flexible Hose	Equivalent Length of 1"/33.7mm Sch. 40 Pipe	
mm inches	Straight Configuration	Bend Configuration
790 31	0.87 2.9	2.70 8.9
915 36	1.00 3.3	2.80 9.2
1220 48	2.23 7.3	4.66 15.3
1525 60	2.90 9.5	6.5 21.3
1830 72	3.31 10.9	7.16 23.5

CCCF NOTE

- Friction loss data is in accordance with GB5135.16 tested at a flow rate of 114 liters per minute (30 gallons per minute).

6.0 NOTIFICATIONS

WARNING



- Read and understand all instructions before attempting to install, remove, adjust, or maintain any Victaulic piping products.
- Always verify that the piping system has been completely depressurized and drained immediately prior to installation, removal, adjustment, or maintenance of any Victaulic products.
- Wear safety glasses, hardhat, and foot protection.

Failure to follow these instructions could result in death or serious personal injury and property damage.

WARNING

- It is the responsibility of the system designer to verify suitability of 300-series stainless steel flexible hose for use with the intended fluid media within the piping system and external environments.
- The effect of chemical composition, pH level, operating temperature, chloride level, oxygen level, and flow rate on 300-series stainless steel flexible hose must be evaluated by the material specifier to confirm system life will be acceptable for the intended service.

Failure to follow these instructions could cause product failure, resulting in serious personal injury and/or property damage.

7.0 REFERENCE MATERIALS – CHARACTERISTICS

VicFlex Maximum Load Values

Series AH2 Hose with 24" Bracket

Model Size	Actual Length ft m	Total Load		Max. Uniform Load	
		lb	N	lb/linear ft	N/linear m
31/790	2.6 0.8	5.2	23	2.6	38
36/915	3 0.9	5.5	25	2.8	40
48/1220	4 1.2	6.3	28	3.1	46
60/1525	5 1.5	7.0	31	3.5	51
72/1830	6 1.8	7.7	34	3.9	57

Series AH2 Hose with 48" Bracket

Model Size	Actual Length ft m	Total Load		Max. Uniform Load	
		lb	N	lb/linear ft	N/linear m
31/790	2.6 0.8	6.1	27	1.5	22
36/915	3 0.9	6.4	29	1.6	23
48/1220	4 1.2	7.2	32	1.8	26
60/1525	5 1.5	7.9	35	2.0	29
72/1830	6 1.8	8.7	39	2.2	32

Total Load is defined as the sum of the weights of the following:

- water-filled flexible sprinkler hose with threaded end fittings, including a typical fire sprinkler
- bracket assembly (any applicable Victaulic bracket model of the relevant associated size)


ASTM C 635: Suspension System Load-Carrying Capabilities (excerpted)

Suspension System	Actual Length ft/m	Min. Allowable Uniform Load	
		lb/linear ft	N/linear m
Direct Hung	Light	5.0	75.7
	Intermediate	12.0	181.0
	Heavy	16.0	241.7

SUMMARY: All direct-hung suspension system duty classifications per ASTM C 635 are able to withstand the maximum water-filled weight of the *VicFlex* sprinkler hose and bracket.

7.0 REFERENCE MATERIALS – CHARACTERISTICS (CONTINUED)

Flexible Hose In-Plane Bend Characteristics

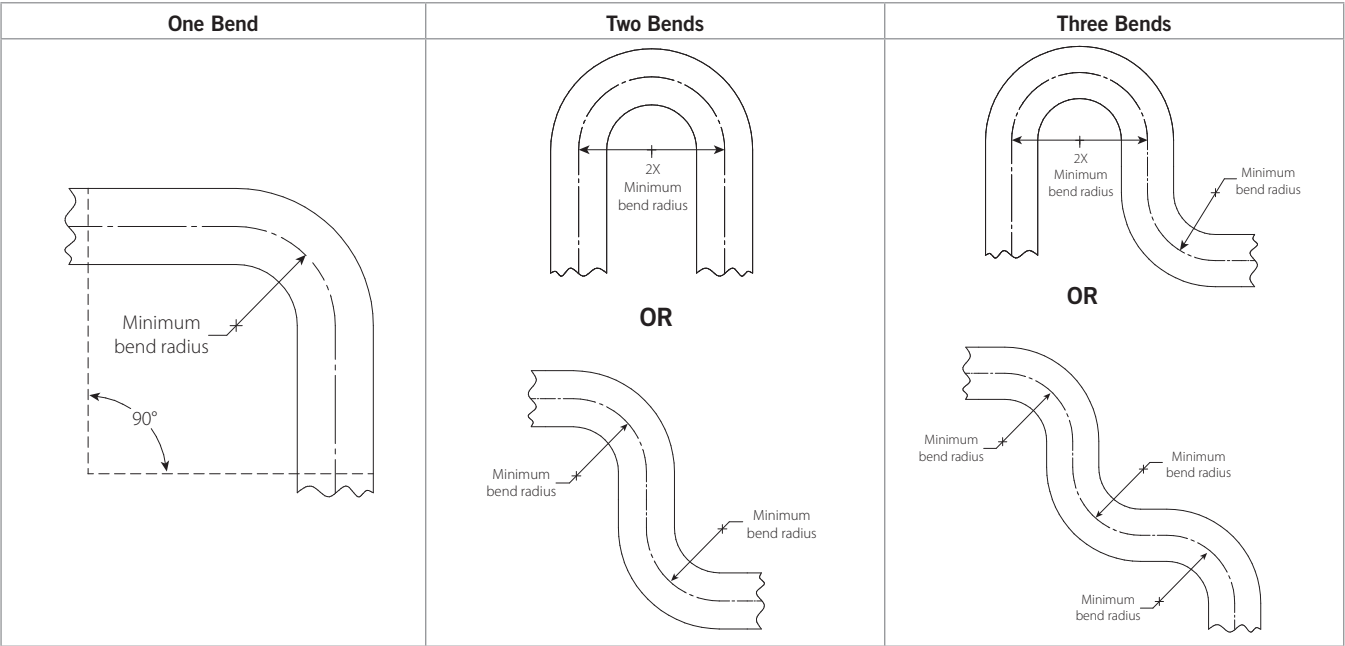

NOTE
For out-of-plane (three-dimensional) bends, care must be taken to avoid imparting torque on the hose.

- [I-VicFlex-AB1-AB2-AB10](#)
- [I-VicFlex-AB3](#)
- [I-VicFlex-AB4](#)
- [I-VicFlex-AB7](#)
- [I-VicFlex-AB8](#)
- [I-VicFlex-AB12](#)
- [I-VicFlex-ABBA](#)
- [I-VicFlex-ABMM](#)

User Responsibility for Product Selection and Suitability
Each user bears final responsibility for making a determination as to the suitability of Victaulic products for a particular end-use application, in accordance with industry standards and project specifications, and the applicable building codes and related regulations as well as Victaulic performance, maintenance, safety, and warning instructions. Nothing in this or any other document, nor any verbal recommendation, advice, or opinion from any Victaulic employee, shall be deemed to alter, vary, supersede, or waive any provision of Victaulic Company's standard conditions of sale, installation guide, or this disclaimer.

Intellectual Property Rights
No statement contained herein concerning a possible or suggested use of any material, product, service, or design is intended, or should be constructed, to grant any license under any patent or other intellectual property right of Victaulic or any of its subsidiaries or affiliates covering such use or design, or as a recommendation for the use of such material, product, service, or design in the infringement of any patent or other intellectual property right. The terms "Patented" or "Patent Pending" refer to design or utility patents or patent applications for articles and/or methods of use in the United States and/or other countries.

Note
This product shall be manufactured by Victaulic or to Victaulic specifications. All products to be installed in accordance with current Victaulic installation/assembly instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.

Installation
Reference should always be made to I-VICFLEX-AB1-AB2-AB10, I-VICFLEX-AB4, I-VICFLEX-AB7, or I-VICFLEX-AB8 for the product you are installing. Handbooks are included with each shipment of Victaulic products for complete installation and assembly data, and are available in PDF format on our website at www.victaulic.com.

Warranty
Refer to the Warranty section of the current Price List or contact Victaulic for details.

Trademarks
Victaulic and all other Victaulic marks are the trademarks or registered trademarks of Victaulic Company, and/or its affiliated entities, in the U.S. and/or other countries.