


PROJECT:

TUKWILA COMMUNITY CENTER BOILER AND CONTROLS UPGRADES

12424 42nd Ave S
Tukwila WA 98168

CONSULTANTS:

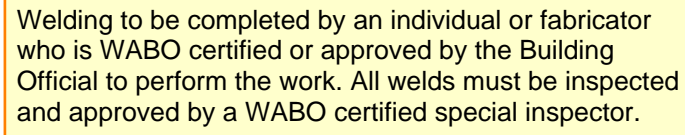


TYPICAL STEEL SKID DETAIL

SCALE: NTS

NOTES:

1. COORDINATE ANGLE CONNECTION LOCATIONS TO AVOID CLASHING WITH HOLE AT THE BASE.
2. PROVIDE CONNECTION AT 4 CORNERS OR @ 0°, 90°, 180°, AND 270°.

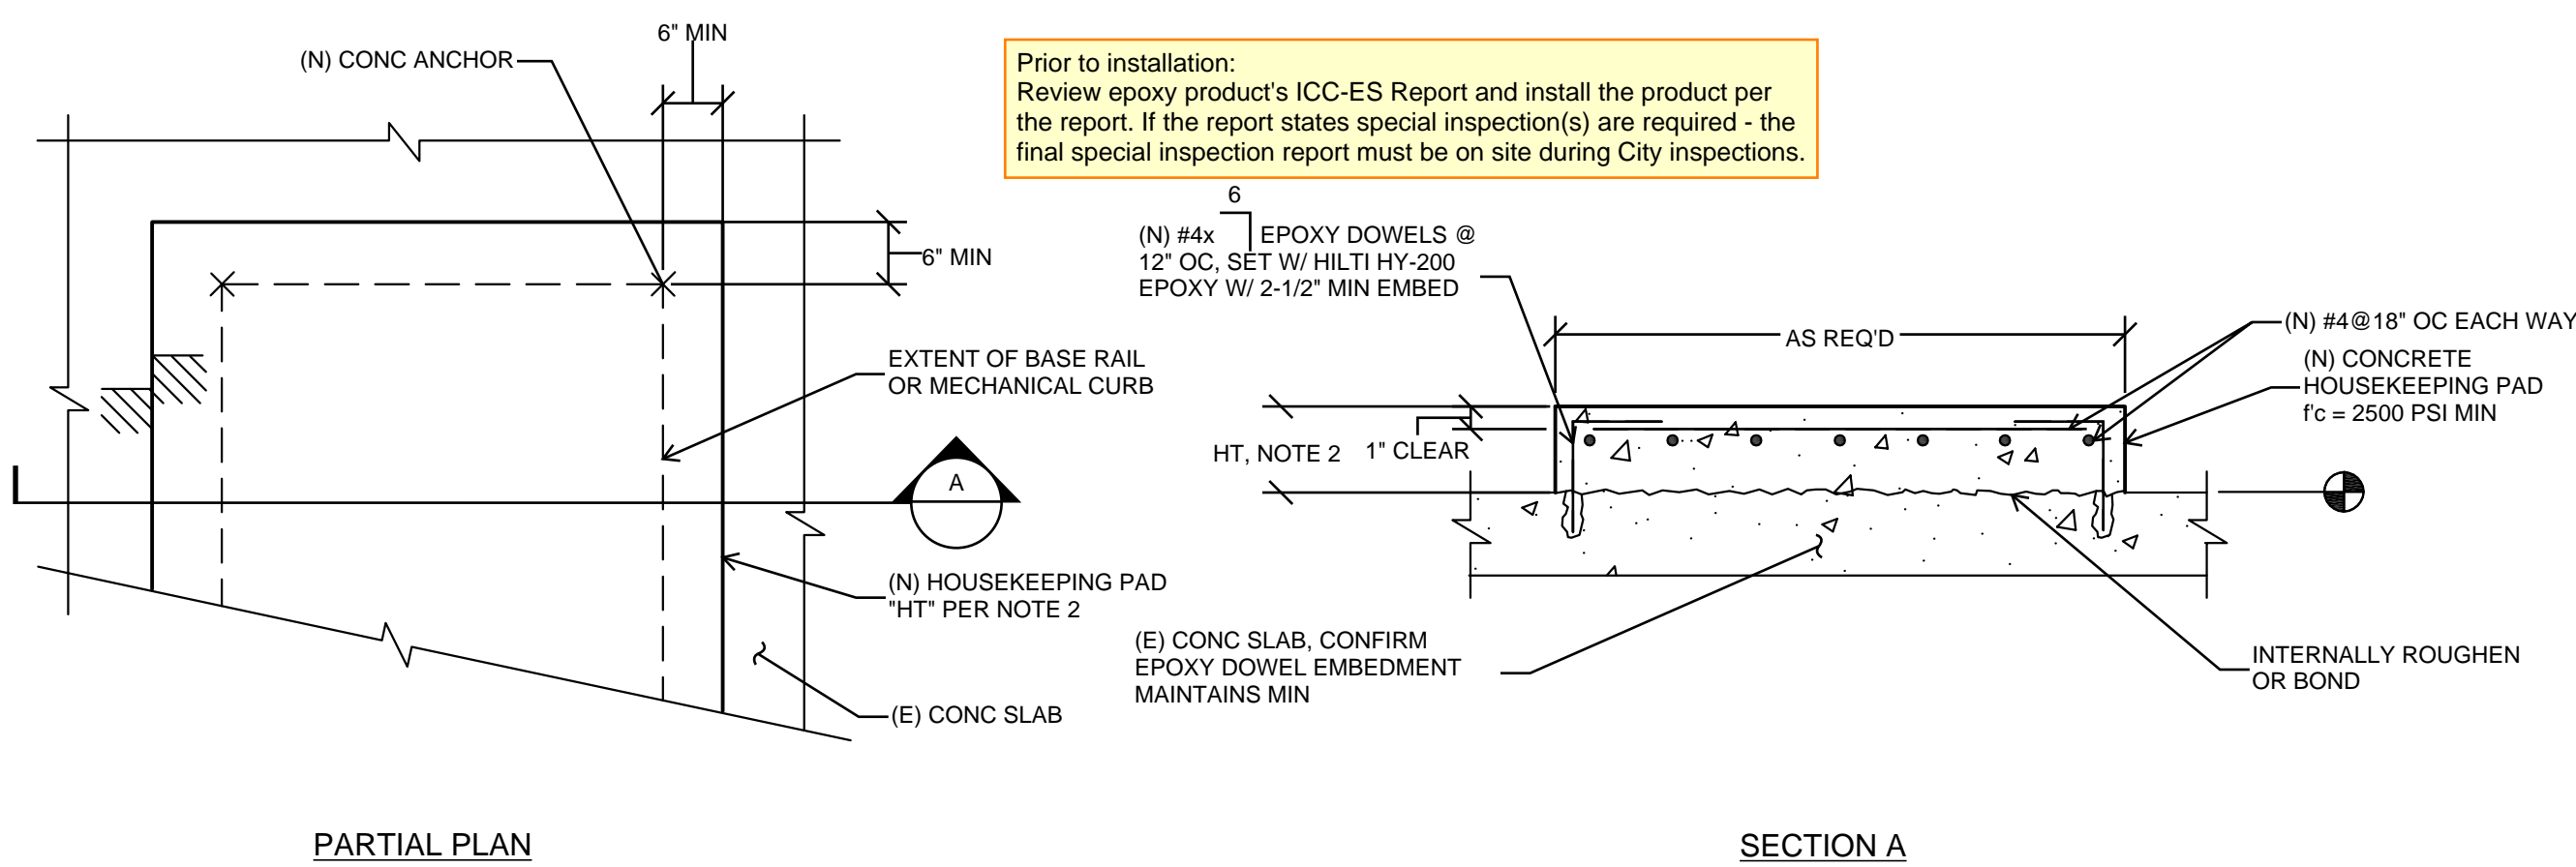

3 TYPICAL HOUSEKEEPING PAD DETAIL


SCALE: NTS

NOTES:
1. PROVIDE HOUSEKEEPING PAD AT MECH EQUIPMENT PER MECH DRAWINGS; COORDINATE HK PAD LAYOUT & LOCATIONS WITH MECH DRAWINGS
2. HT = 4" MIN OR MATCH EXISTING HT AT HK PAD LOCATIONS TYP UNO.
3. SEE GENERAL NOTES FOR ADDED INFO.



AIR SEPERATOR SUPPORT DETAIL

SCALE: NTS

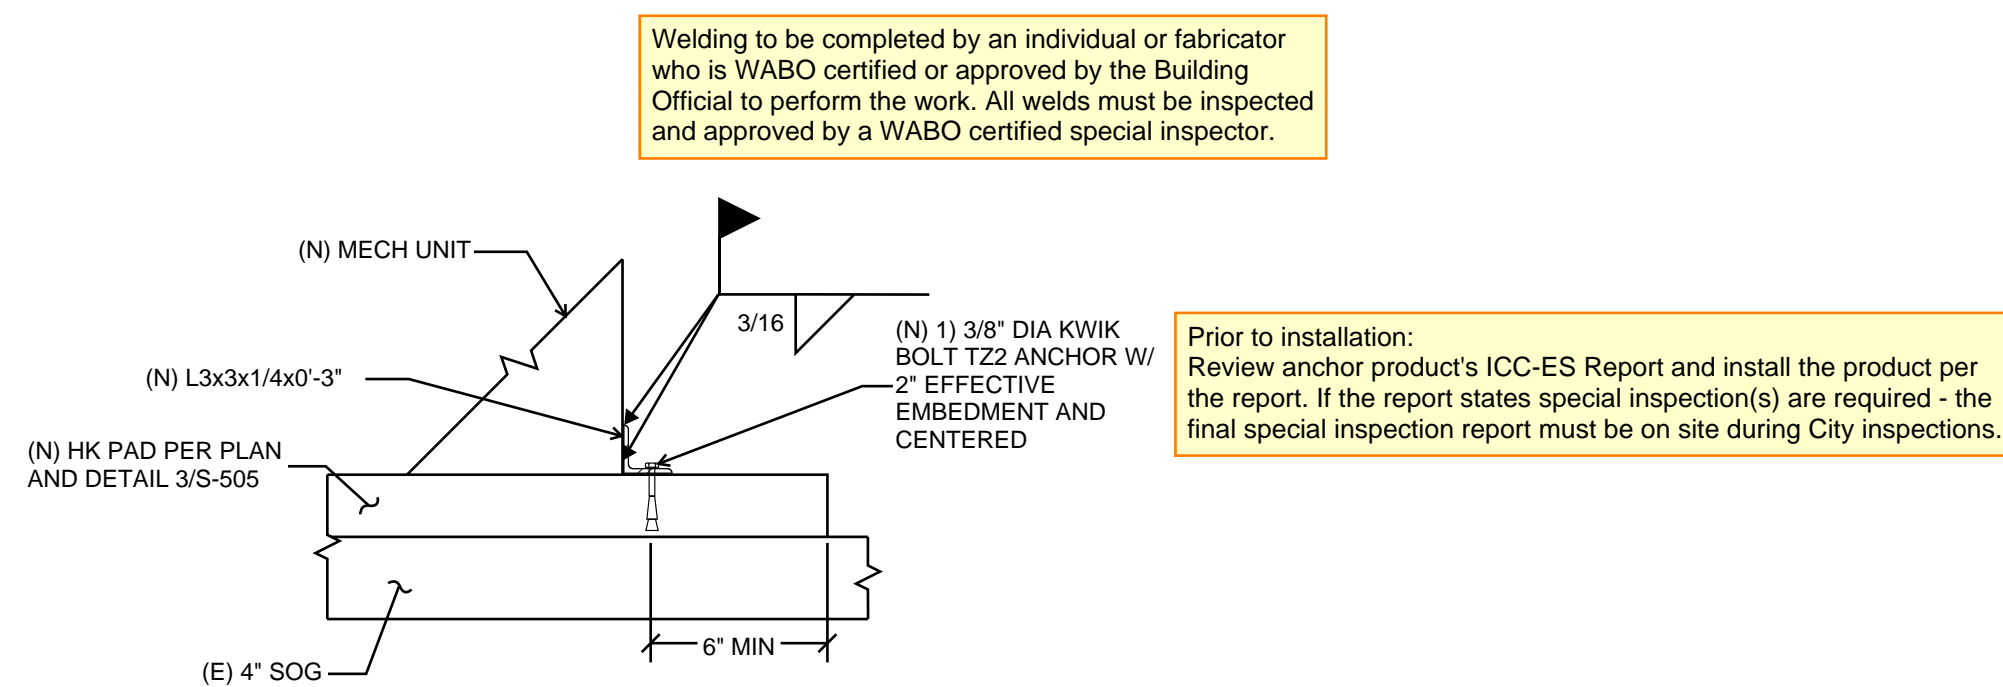


CONNECTION DETAIL

SCALE: NTS

NOTES:

1. COORDINATE ANGLE CONNECTION LOCATIONS TO AVOID CLASHING WITH HOLES AT THE BASE.
2. PROVIDE CONNECTION AT 4 CORNERS OR @ 0°, 90°, 180°, AND 270°.

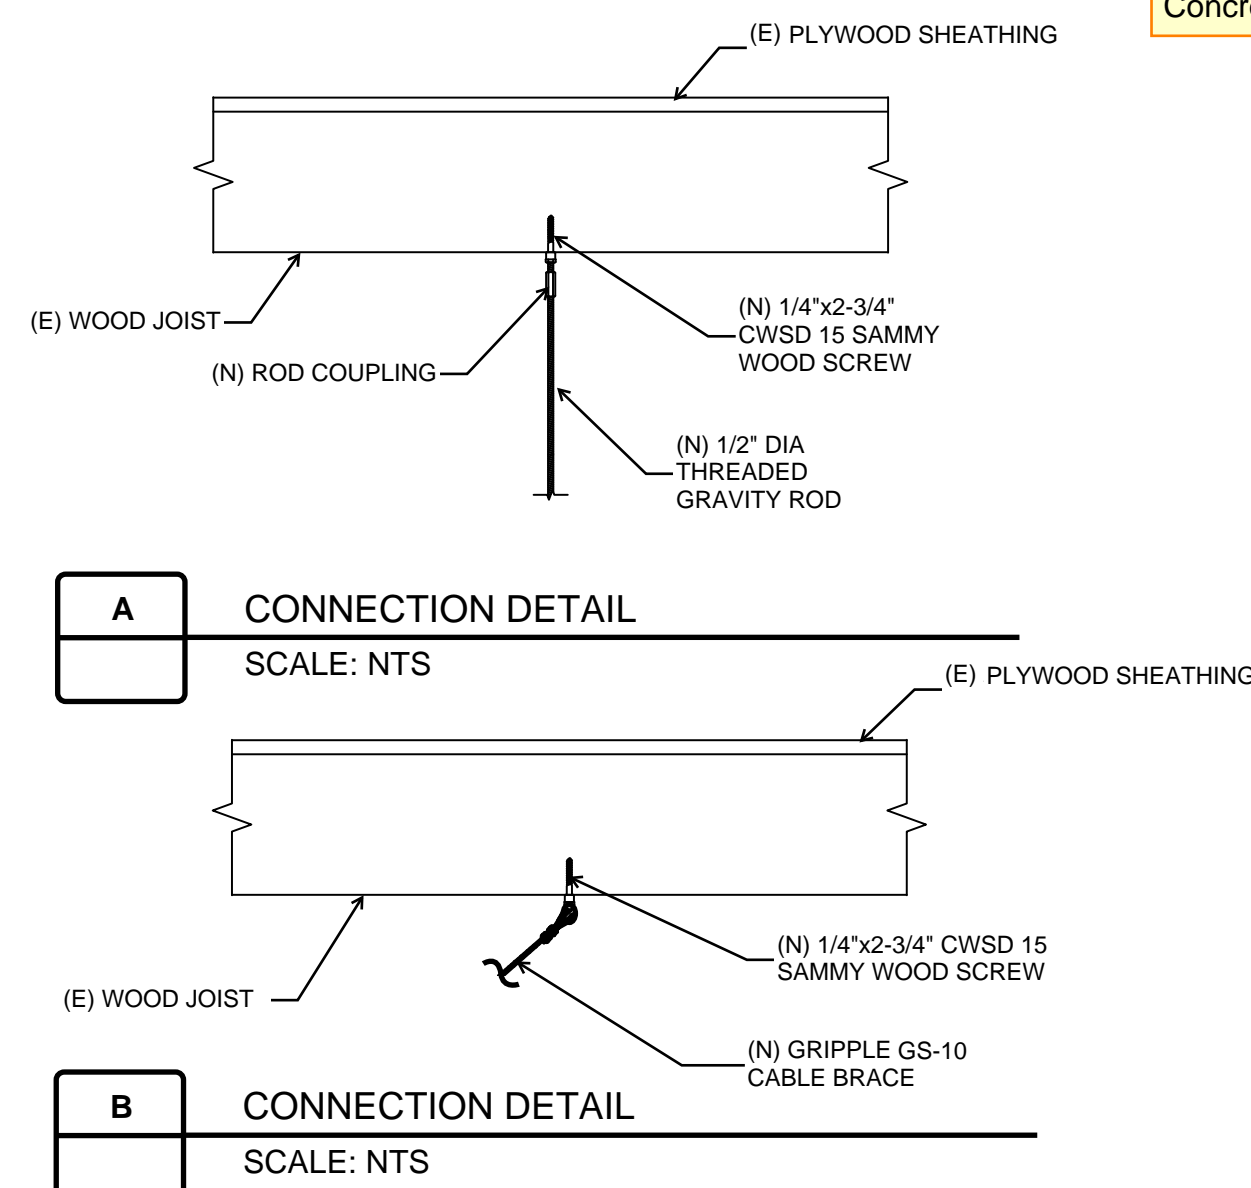


CONNECTION DETAIL

SCALE: NTS

CONNECTION DETAIL

SCALE: NTS

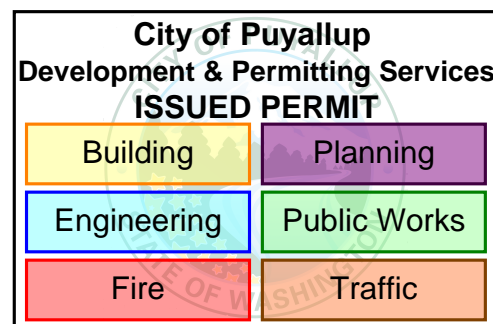

**City of Puyallup
Building
REVIEWED
FOR
COMPLIANCE**

BSnowden
07/17/2025
10:06:59 AM



The approved construction plans, documents, and all engineering must be posted on the job at all inspections in a visible and readily accessible location.


Full sized legible color plans are re
the permittee on site for inspection.

Approval of submitted plans is not an approval of omissions or oversights by this office or non compliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable codes and regulations of the local government.

ISSUE

PERMIT SET
08/14/2024

REGISTRATION:

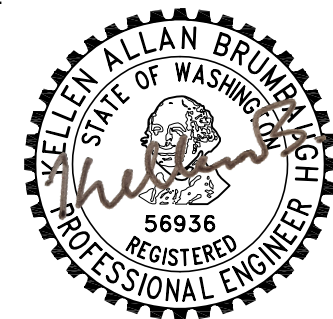

EXPIRES: 1-30-26

THIS IS AN ELECTRONIC SIGNATURE. DIGITAL
STAMP ORIGINAL ON FILE AT MCKINSTRY

ISSUES

[illegible]

SR ENGINEER: KAB

DRAWN BY: KAB

QC BY: KAB

JOB NO: 207616-002

ISSUED ON: 08/14/2024

SHEET TITLE

STRUCTURAL DETAILS

SHEET NUMBER

S-500