

TEAM INFORMATION:

ASH DEVELOPMENT, LLC PUYALLUP, WA c/io: GREG HELLE 253-318-5711

greg.helle@absherco.com

SYNTHESIS 9, LLC TACOMA, WA c/o: BRETT LINDSAY 253-468-4117

blindsay@synthesis9.com

CIVIL ENGINEER:

AHBL, INC. TACOMA, WA c/o: TODD SAWIN 253-383-2422 tsawin@AHBL.com

STRUCTURAL ENGINEER:

SITTS & HILL TACOMA, WA c/o: CALEB TIMMER 253-474-9449

City of Puyallup Development & Permitting Service ISSUED PERMIT				
Building	Planning			
Engineering	Public Works			
Fire				

TABLE OF CONTENTS

ARCHITECTURAL

SITE PLAN & PROJECT INFORMATION

STRUCTURAL ** NOT TO SCALE

GENERAL NOTES & TYPICAL SECTION

TYPICAL DETAILS & ELEVATIONS

4-STALL TYPE 1 FOUNDATION & FRAMING PLANS (#11)

4-STALL TYPE 2 FOUNDATION & FRAMING PLAN (#1)

4-STALL TYPE 3 FOUNDATION & FRAMING PLAN (#3, 8, 13, 15, 16)

4-STALL TYPE 4 FOUNDATION & FRAMING PLAN (#14)

4-STALL W/ LONG SPAN FOUNDATION & FRAMING PLAN (#2)

5-STALL FOUNDATION & FRAMING PLAN

6-STALL TYPE 1 FOUNDATION & FRAMING PLAN (#4)

6-STALL TYPE 2 FOUNDATION & FRAMING PLAN (#6)

6-STALL W/ LONG SPAN FOUNDATION & FRAMING PLAN (#7, 11, 17)

9-STALL W/ LONG SPAN TYPE 1 FOUNDATION & FRAMING PLAN (#9, 10)

9-STALL W/ LONG SPAN TYPE 2 FOUNDATION & FRAMING PLAN (#12)

S14.0 8-STALL FOUNDATION & FRAMING PLAN (#5)

SEE APPROVED CIVIL PLANS FOR GRADING, UTILITIES & TEMPORARY EROSION CONTROL PLANS

BUILDING SUMMARY

DESCRIPTION: CARPORT APPLICABLE BUILDING CODE: 2021 IBC FIRE SPRINKLERS: NO FIRE ALARM SYSTEM AND SMOKE ALARM: NO OCCUPANCY: U TYPE OF CONSTRUCTION: VB

OCCUPANT LOAD:

FUNCTION OF SPACE: ACCESSORY STORAGE OCCUPANT LOAD FACTOR: 200 (GROSS) OCCUPANT LOAD : 420/200= 2

PROPOSED GROSS AREA: 420 sq ft PROPOSED HEIGHT:

BASE ALLOWABLE BUILDING AREAS, HEIGHT AND STORIES:

ALLOWABLE AREA PER FLOOR: 13,500 sq ft ALLOWABLE MAXIMUM HEIGHT: 40 ft

PROJECT SCOPE

INSTALL 1 OF 17 PRE-MANUFACTURED CARPORTS

APPLICABLE CODES:


INTERNATIONAL BUILDING CODE (2021) ANSI 117.1 (2017) **INTERNATIONAL MECHANICAL CODE (2021)** INTERNATIONAL FIRE CODE (2021) INTERNATIONAL ELECTRICAL CODE (2021) **UNIFORM PLUMBING CODE (2021)** WASHINGTON STATE ENERGY CODE (2021) PORT ORCHARD LAND USE CODE WASTEWATER AND SURFACE WATER MANAGEMENT - CHAPTER 12.08 PUBLIC WORKS DESIGN MANUAL

AS1.0



SYNTHESIS 9, LLC

523 N. D ST. TACOMA, WA 98403 REUSE OF DOCUMENTS



P20250899 PRC

CROSSING PUYALLUP 1

REVISIONS

REVISIONS

CHECKED BY: SITE PLAN & Carport No.1 PROJECT INFO

PROJECT #:

BUILDING CODE:

2021 EDITION OF THE INTERNATIONAL BUILDING CODE (IBC) SHALL BE USED AND SUPPLEMENTED WITH (ASCE) 7-16.

BUILDING CODE REFERENCES:

ALL CODE REFERENCES HEREAFTER SHALL CORRESPOND TO THE FOLLOWING EDITIONS. U.N.O.:

CODE EDITION MATERIAL

CONCRETE BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE AND COMMENTARY, (ACI 318)-19. 2004 ACI DETAILING MANUAL (ACI SP-66). REINFORCING 15TH EDITION OF (AISC) STEEL CONSTRUCTION STEEL MANUAL.

STRUCTURAL WELDING CODE - STEEL, (AWS) WELDING

D1.1-20.LIGHT GAGE STEEL 2016 (AISI) NORTH AMERICAN SPECIFICATION

FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS WITH SUPPLEMENT 2.

1.03 PSF

LOADS:

RISK CATEGORY = II

DESIGN DATA:

ROOF DEAD LOAD AT CARPORTS DL ROOFING AND TRIM DL FOR PURLINS

SELF WEIGHT ROOF SNOW LOAD 25 PSF

WIND:

THE WIND LOADS ARE DETERMINED IN ACCORDANCE WITH ASCE 7-16:

BASIC WIND SPEED V: 110 MPH **EXPOSURE CATEGORY:** WIND IMPORTANCE FACTOR: 1.0

SEISMIC:

IMPORTANCE FACTOR le = 1.0LATITUDE = 47.213645; LONGITUDE = -122.365315Ss = 1.308, S1 = 0.451, SEISMIC SITE CLASS = DSds = 1.047, Sd1 = 0.834, SEISMIC DESIGN CATEGORY = DRW = 1.25 STEEL ORDINARY CANTILEVERED COLUMNS CS = 0.838

FOUNDATION:

GROUND TO BE SW, SP, SM, SC GM & GC PER IBC TABLE 1806.2 ALLOWABLE SOIL: BEARING CAPACITY (DL+LL): 2,000 PSF

CONTRACTOR SHALL VERIFY SOIL CONDITION PRIOR TO PROCEEDING WITH CONSTRUCTION

CONCRETE:

MINIMUM COMPRESSIVE STRENGTH OF CONCRETE SHALL BE 3,000 PSI TO COMPLY WITH EXPOSURE REQUIREMENT OF IBC TABLE 1904.1. STRUCTURAL DESIGN IS BASED ON f'c OF 2,500 PSI. PER IBC 1705.3, NO SPECIAL INSPECTION IS REQUIRED.

ALL CONCRETE CONSTRUCTION SHALL CONFORM TO ACI. MAXIMUM WATER/CEMENT RATIO (W/C) SHALL BE 0.55. PROVIDE AIR ENTRAINMENT (5% \pm 1%) IN CONCRETE EXPOSED TO FREEZE-THAW ACTION.

STRUCTURAL STEEL:

STRUCTURAL STEEL MATERIALS, FABRICATION AND ERECTION SHALL CONFORM TO CURRENT AISC STEEL CONSTRUCTION MANUAL IN ACCORDANCE TO IBC CHAPTER 22. PAINT ALL STRUCTURAL STEEL EXPOSED TO WEATHER UNLESS NOTED OTHERWISE ON DRAWINGS.

MATERIAL SPECIFICATION, UNLESS NOTED OTHERWISE:

STRUCTURAL SHAPES: ASTM A992 GRADE 50 BARS AND PLATES: ASTM A36 STRUCTURAL TUBING/HSS: ASTM A500, GRADE B (FY = 46 KSI)ASTM A307

ASTM F436 FLAT; BEVELED WASHERS: ASTM F959 DIRECT-TENSION WASHERS:

FILLER METAL: E70XX ELECTRODES, ALL

WELDS SHALL BE SINGLE PASS 3/16" UNLESS NOTED OTHERWISE

COLD FORMED SHAPES: ASTM A653, FY = 50 KSIROOF METAL DECK: ASTM A792. FY = 80 KSI

SCREW FASTENERS:

SELF DRILLING AND SELF-TAPPING SCREWS SHALL BE #12-14 TEK SCREWS OR APPROVED EQUAL AND SHALL CONFORM TO ASTM A545 OR SAEJ78. SAEJ93 OR ANSI/ASMEB18.6.4.

ROOFING:

1 3/8" PROFILE x 26 GA ROOF DECK (V-LINE 32) OR EQUIVALENT WITH #12-14 TEK SCREWS AT 9" O.C. UNLESS NOTED OTHERWISE OR (4) SCREWS PER 32" WIDE PANEL @ EACH SUPPORT

ROOFING IS V-LINE 32 - 26 GA

GAUGE	WT.	S+	+	S-	
	(IBS/FT2)	(IN3/FT)	(IN4/FT)	(IN3/FT)	(IN4/FT)
26	0.91	0.0847	0.0619	0.0833	0.0619

PURLINS:

ALL PURLINS ARE ASTM A653 CEE 10 X 3 1/2 X 12 GAUGE UNLESS NOTED OTHERWISE. WITH THE FOLLOWING MINIMUM GROSS PROPERTIES:

GAUGE	DEPTH	FLANGE	LIP	SX	IX	Fy
	(IN)	(IN)	(IN)	(IN3)	(IN4)	(KSI)
12	10.00	3.5	1.0	5.63	28.148	50

GENERAL:

THE STRUCTURAL CONSTRUCTION DOCUMENTS REPRESENT THE FINISHED STRUCTURE. THEY DO NOT INDICATE THE METHOD OF CONSTRUCTION. THE CONTRACTOR SHALL PROVIDE ALL MEASURES NECESSARY TO PROTECT THE STRUCTURE DURING CONSTRUCTION. SUCH MEASURES SHALL INCLUDE, BUT ARE NOT LIMITED TO BRACING AND SHORING FOR LOADS DUE TO CONSTRUCTION EQUIPMENT, ETC. THE STRUCTURAL ENGINEER SHALL NOT BE RESPONSIBLE FOR THE CONTRACTOR'S MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURE OF CONSTRUCTION, OR THE SAFETY PRECAUTIONS AND THE PROGRAMS INCIDENT THERETO (NOR SHALL OBSERVATION VISITS TO THE SITE INCLUDE INSPECTION OF THESE ITEMS).

CONSTRUCTION MATERIALS SHALL BE SPREAD OUT IF PLACED ON FRAMED CONSTRUCTION. LOAD SHALL NOT EXCEED THE DESIGN LIVE LOAD PER SQUARE

WHERE REFERENCE IS MADE TO VARIOUS TEST STANDARDS OR MATERIALS. SUCH STANDARDS SHALL BE THE LATEST EDITION AND/OR ADDENDA.

ESTABLISH AND VERIFY ALL OPENINGS AND INSERTS FOR MECHANICAL, PLUMBING AND ELECTRICAL WITH APPROPRIATE TRADES, DRAWINGS AND SUBCONTRACTORS PRIOR TO CONSTRUCTION.

OPTIONS ARE FOR CONTRACTOR'S CONVENIENCE. IF AN OPTION IS CHOSEN, CONTRACTOR SHALL BE RESPONSIBLE FOR ALL NECESSARY CHANGES AND SHALL COORDINATE ALL DETAILS.

AS REV. ON DRAWING: SUBJECT OF REVISION: REVISION #: DATE:

NOTES AND DETAILS ON DRAWINGS SHALL TAKE PRECEDENCE OVER GENERAL STRUCTURAL NOTES AND TYPICAL DETAILS. WHERE NO DETAILS ARE SHOWN, CONSTRUCTION SHALL CONFORM TO SIMILAR WORK ON THE PROJECT.


CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF ALL DIMENSIONS WITH OWNER PRIOR TO START OF CONSTRUCTION. RESOLVE ANY DISCREPANCY WITH THE OWNER.

TYPICAL DETAILS MAY NOT NECESSARILY BE CUT ON PLANS, BUT APPLY, U.N.O.


WHERE DISCREPANCIES OCCUR BETWEEN PLANS, DETAILS, GENERAL STRUCTURAL NOTES AND/OR SPECIFICATIONS, THE GREATER REQUIREMENTS SHALL GOVERN.


ANY ENGINEERING DESIGN, PROVIDED BY OTHERS AND SUBMITTED FOR REVIEW, SHALL BEAR THE SEAL OF A REGISTERED ENGINEER RECOGNIZED BY THE BUILDING

CODE JURISDICTION OF THIS PROJECT.



TYPE:

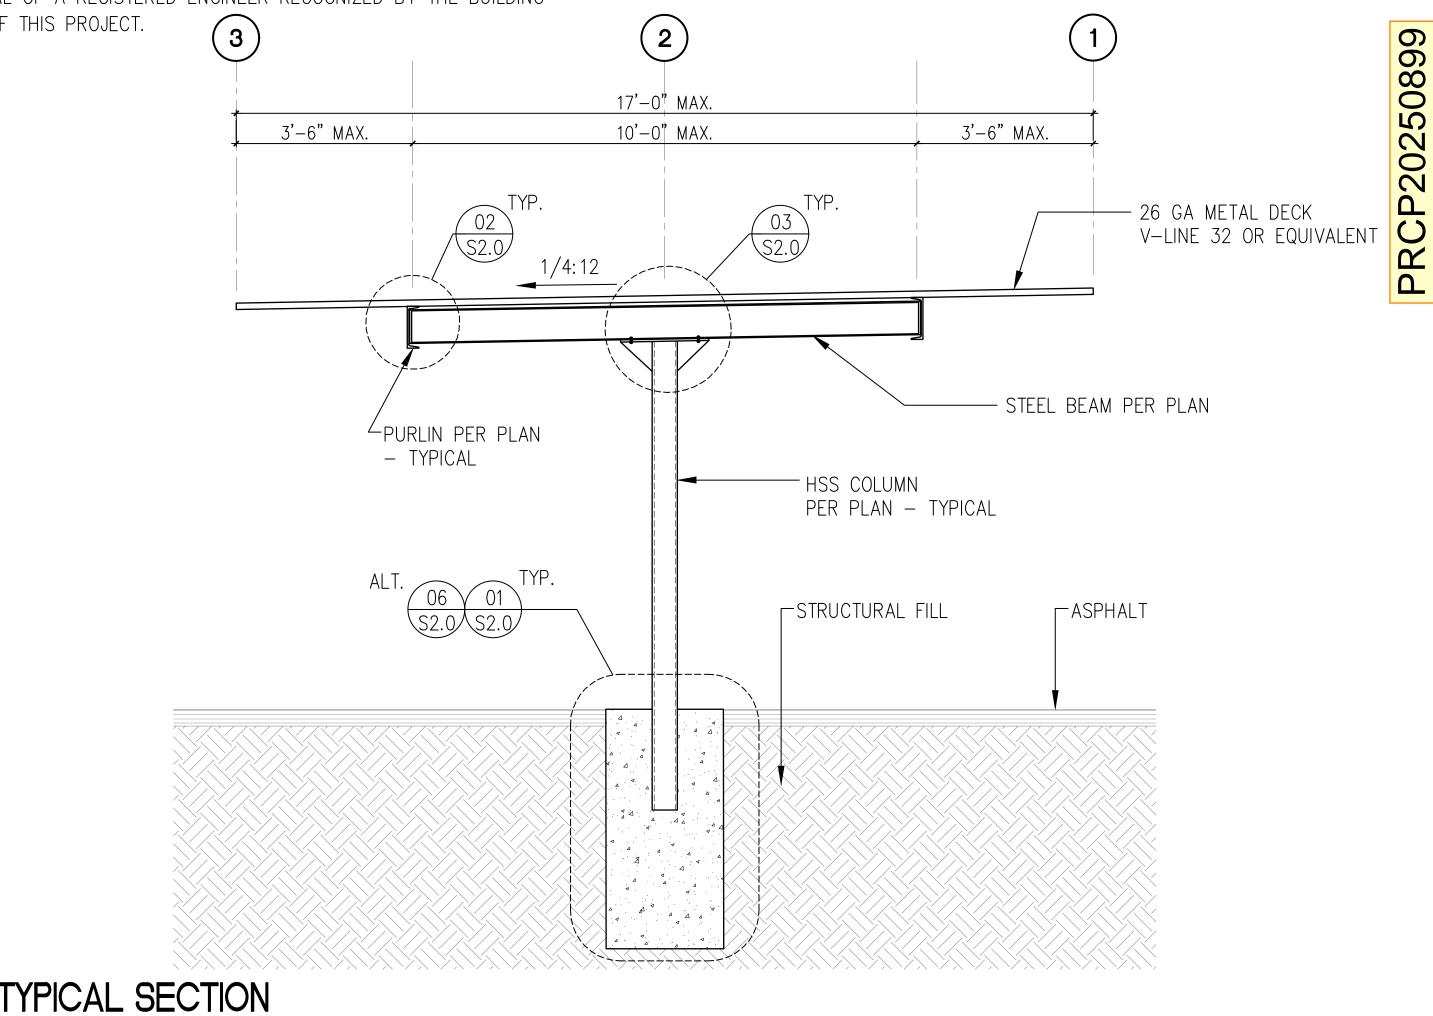





EAST TOWN CROSSING CARPORTS

PIONEER WAY E PUYALLUP, WA 9837


GENERAL STRUCTURAL NOTES AND TYPICAL SECTION


CARPORTS OF WASHINGTON


P.O. BOX 2389 BUCKLEY, WASHINGTON 98321



					_
CIVIL	STRU	CTURAI	L SU	RVEY	
4815 CENTER	STREET	1	TACOMA	, WA. 98409)
PHONE: (253) 474-9449	I	FAX: (25	3) 474-0153	ò
	http://wv	ww.sittshil	II.com/		

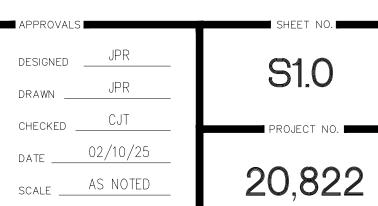

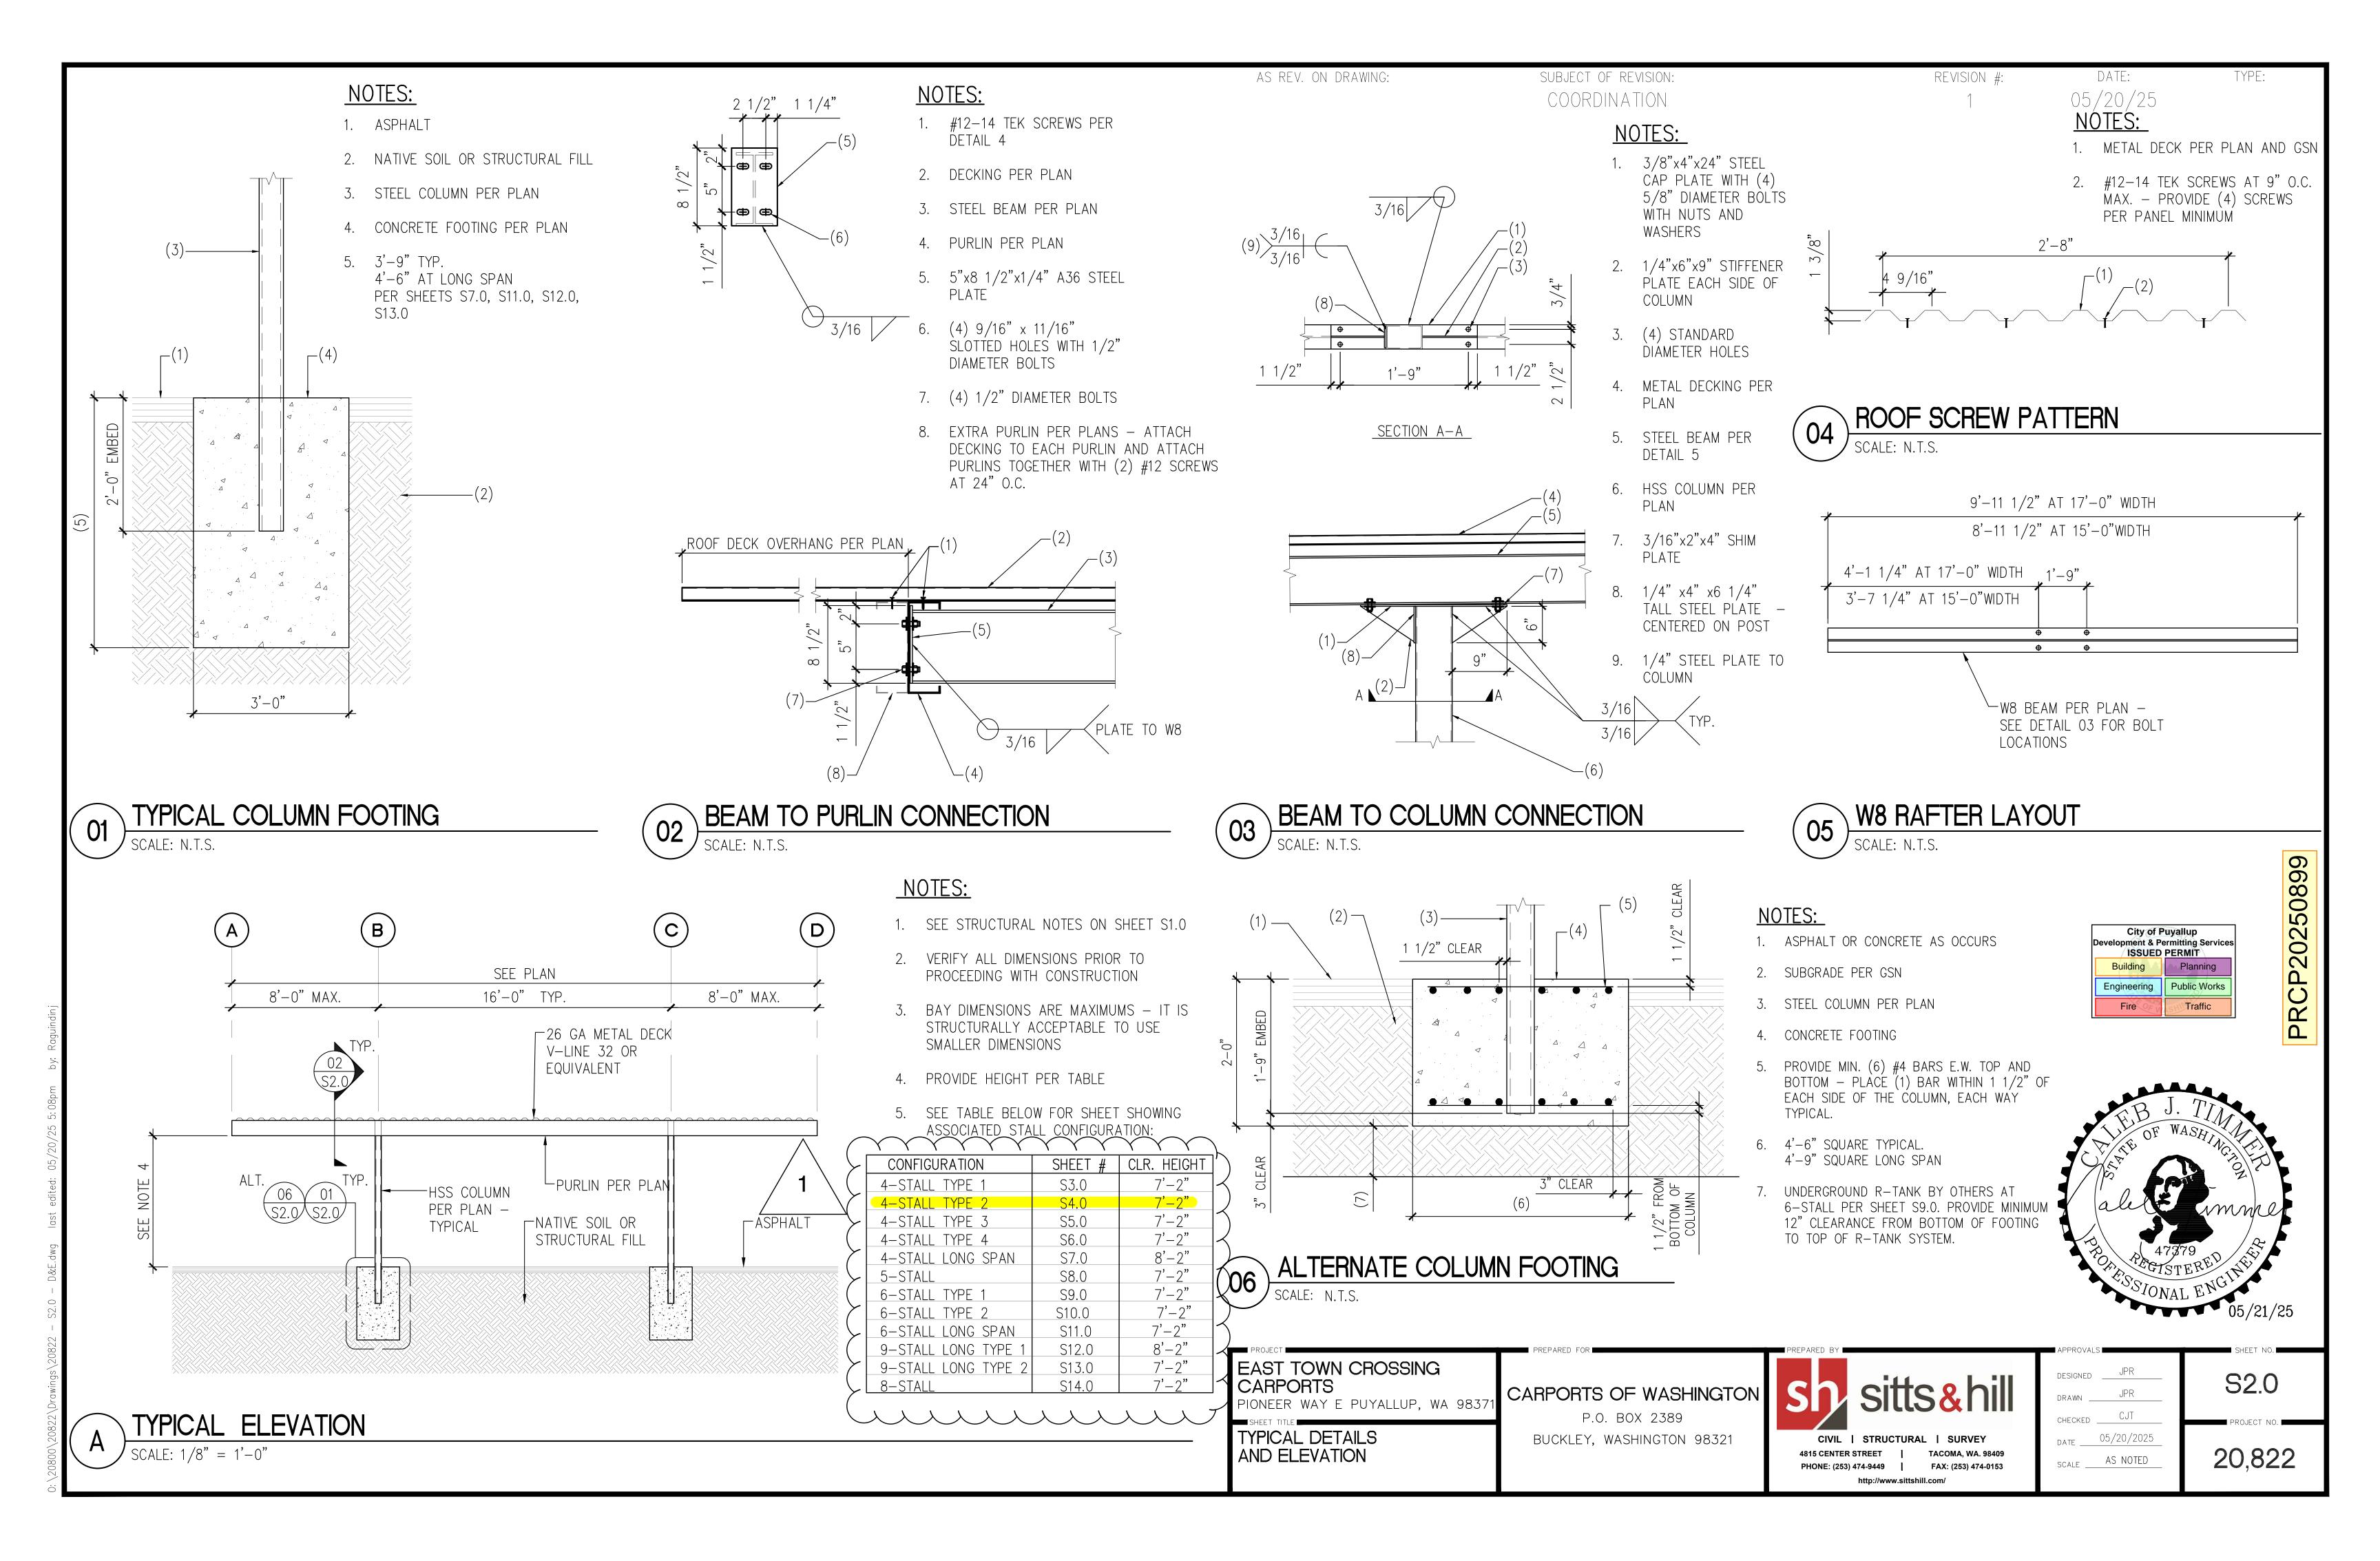

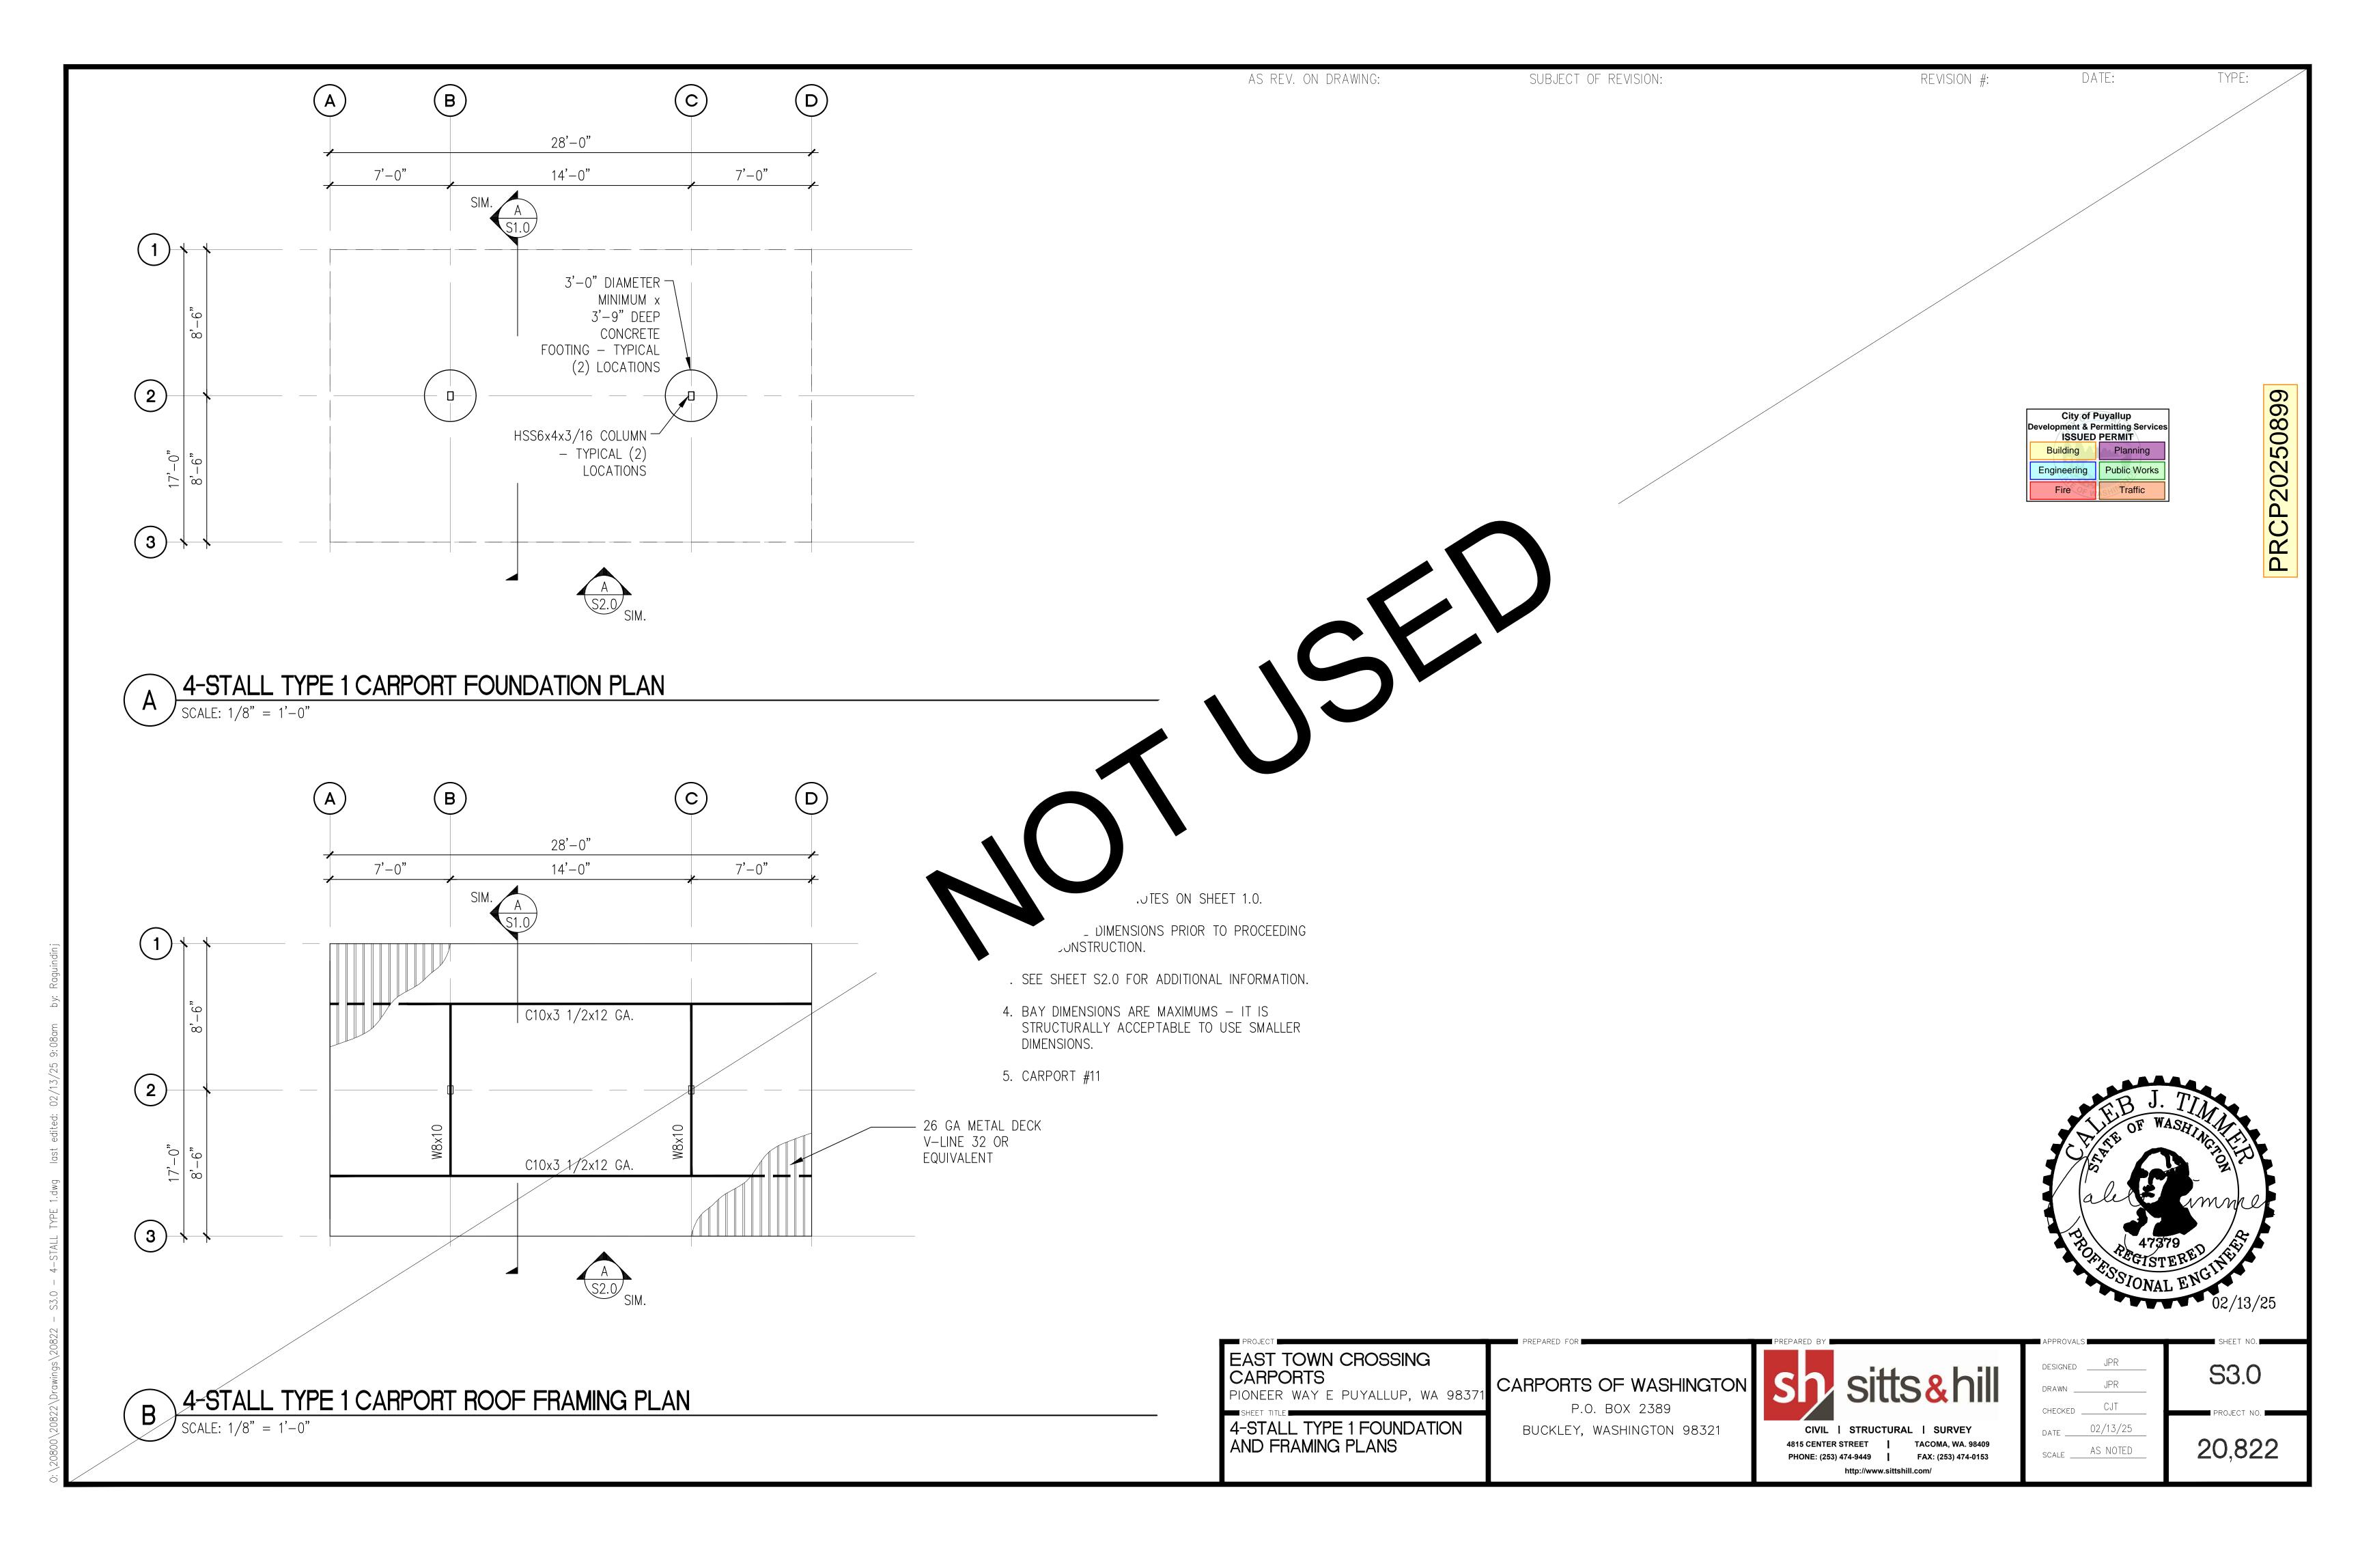



4-STALL TYPE 2 CARPORT FOUNDATION PLAN

(B)

7'-0"


(C)

28**'**-0"

14'-0"

(D)

7'-0"

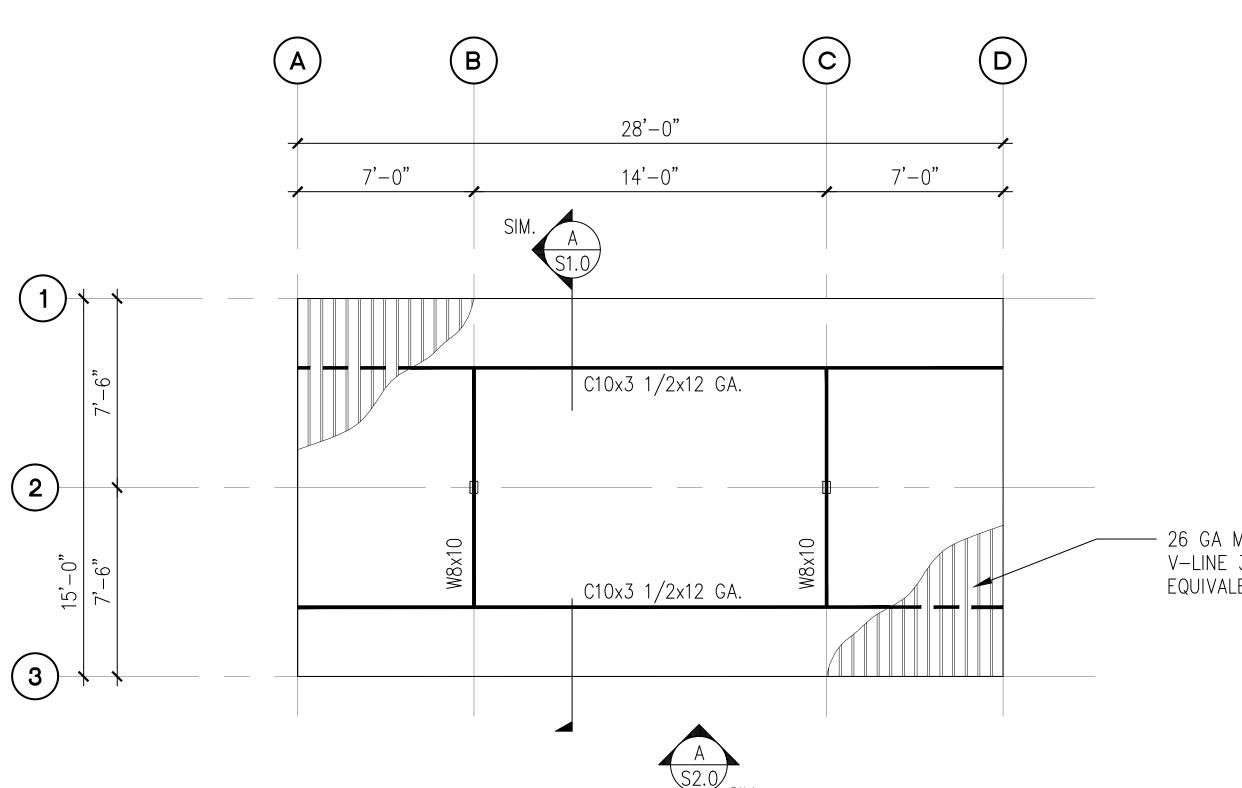


NOTES:

- 1. SEE STRUCTURAL NOTES ON SHEET 1.0.
- 2. VERIFY ALL DIMENSIONS PRIOR TO PROCEEDING WITH CONSTRUCTION.
- 3. SEE SHEET S2.0 FOR ADDITIONAL INFORMATION.
- 4. BAY DIMENSIONS ARE MAXIMUMS IT IS STRUCTURALLY ACCEPTABLE TO USE SMALLER DIMENSIONS.

5. CARPORT #1

- 26 GA METAL DECK V-LINE 32 OR EQUIVALENT

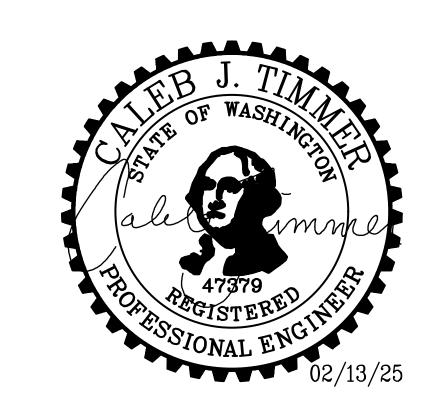

B 4-STALL TYPE 2 CARPORT ROOF FRAMING PLAN

SCALE: 1/8" = 1'-0"

EAST TOWN CROSSING CARPORTS PIONEER WAY E PUYALLUP, WA 98371

4-STALL TYPE 2 FOUNDATION AND FRAMING PLANS

CARPORTS OF WASHINGTON

P.O. BOX 2389 BUCKLEY, WASHINGTON 98321

Sh	sitts&hill
CIVIL	STRUCTURAL SURVEY


						-	_		
CIVIL	l	STRUC	CTU	JRAL	l s	URV	ΕY		
4815 CENTER	R S	TREET	I	T.	ACON	IA, W	A. 98	340	9
PHONE: (253) 4	74-9449	I	F	AX: (253) 4	74-0	15	3
http://www.sittshill.com/									

ROVALS			SHEET NO.
GNED	JPR	_	040
WN	JPR	_	54.0
CKED _	CJT	_	PROJECT NO.
	02/13/25		

SCALE ____AS NOTED

20,822


PRCP20250899

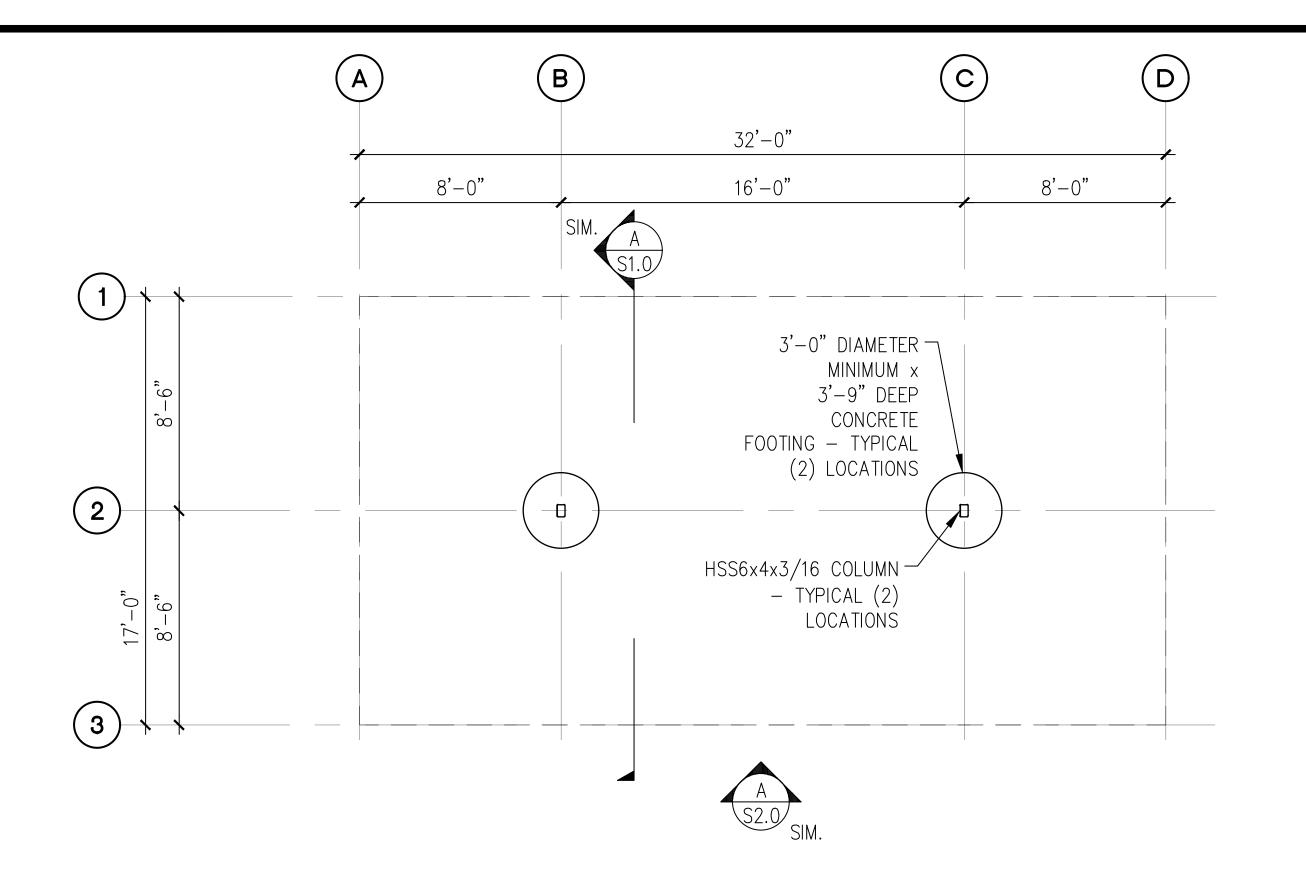

CONTRACTOR NOTE Not Used for Carport #1

Engineering

4-STALL TYPE 3 CARPORT FOUNDATION PLAN SCALE: 1/8" - 1' 0"

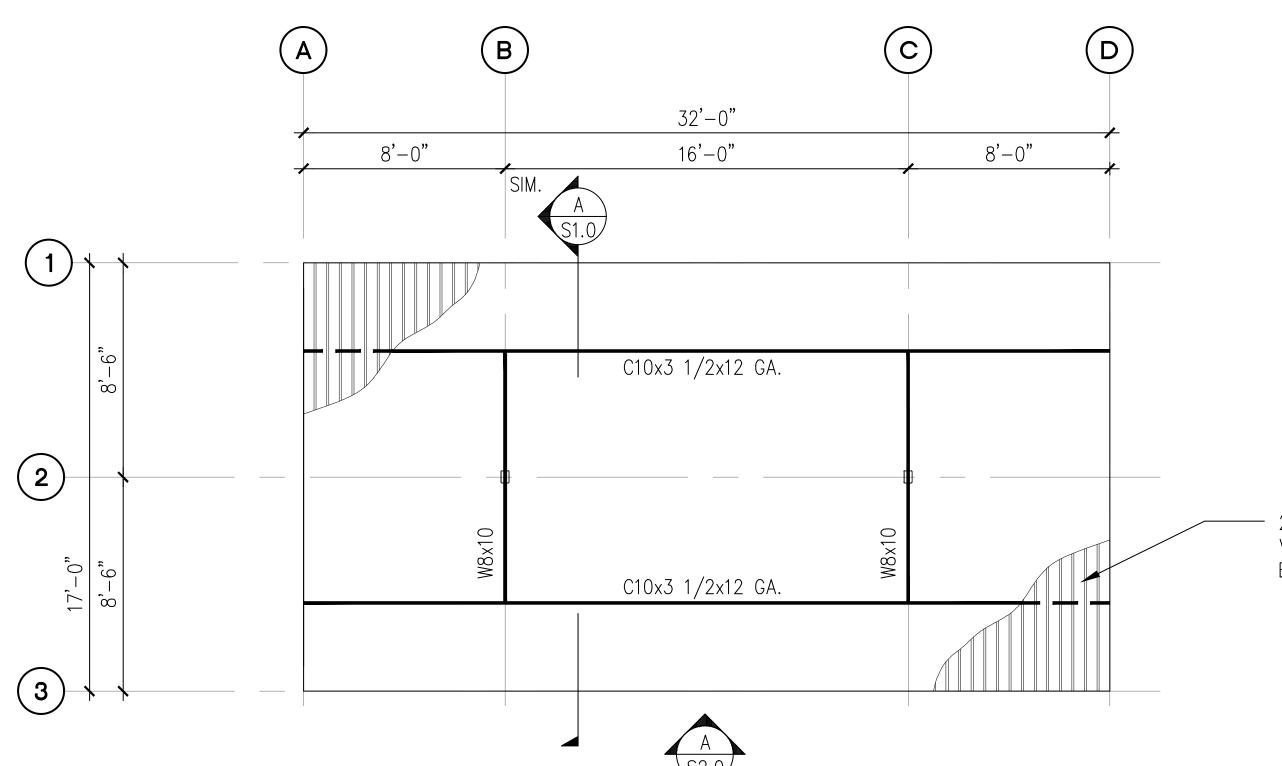

NOTES:

- 1. SEE STRUCTURAL NOTES ON SHEET 1.0.
- 2. VERIFY ALL DIMENSIONS PRIOR TO PROCEEDING WITH CONSTRUCTION.
- 3. SEE SHEET S2.0 FOR ADDITIONAL INFORMATION.
- 4. BAY DIMENSIONS ARE MAXIMUMS IT IS STRUCTURALLY ACCEPTABLE TO USE SMALLER DIMENSIONS.
- 5. CARPORTS #3,8,13,15,16

26 GA METAL DECK V-LINE 32 OR EQUIVALENT



B 4-STALL TYPE 3 CARPORT ROOF FRAMING PLAN
SCALE: 1/8" = 1'-0"

EAST TOWN CROSSING CARPORTS PIONEER WAY E PUYALLUP, WA 9837

4-STALL TYPE 3 FOUNDATION AND FRAMING PLANS

CARPORTS OF WASHINGTON P.O. BOX 2389

BUCKLEY, WASHINGTON 98321

CIVIL | STRUCTURAL | SURVEY TACOMA, WA. 98409 PHONE: (253) 474-9449 FAX: (253) 474-0153

http://www.sittshill.com/

APPROVAL:	S	—	SHEET NO
DESIGNED	JPR		OF C
DRAWN	JPR		5 3.U
CHECKED	CJT		PROJECT N
DATE	02/13/25		

20,822 scale ____AS NOTED

