City of Puyallup

Engineering Division

333 S. Meridian, Puyallup, WA 98371 (253) 864-4165 www.cityofpuyallup.org

INSPECTION REPORT

Date of Inspection: Aug 14, 2025 Inspection Result: PARTIAL PASS

Permit Number: PRCCP20240808

Property Address: 911 SHAW RD, PUYALLUP, WA 98372; 901 SHAW RD, PUYALLUP, WA

98372; 813 SHAW RD, PUYALLUP, WA 98372;

Contractor: MCKEE ENTERPRISES, LLC PO BOX 5 ENUMCLAW, WA 98022 **To construct:** Phase 2 site development of East Town Crossing including grading,

storm drainage, parking, and utilities per plans. - 731 SHAW RD

On this day we have inspected your construction for **Engineering Daily Inspection** and we find the following result of the inspection. If there are any questions, please contact the inspector below.

Comments: Phase 2

8/12 - The clubhouse fire line was bag flushed today. We bag flushed from the FDC with 2-2.5" hoses and from the building flange with 2-2.5" hoses. We bag flushed 4 times at 15min. each time. (PASSED) 8/14 - I inspected the plumbers sewer connection. (PASSED)

The water service failed inspection. There can not be any fittings under the footing or the slab. The water service should be once continuous piece.

Phase 1

Throughout the week contractors have been working diligently around building G & H for a final building inspection.

C_{Δ}	rre	cti	^	nc.
	116	(()	115


Sincerely,



City of Puyallup

Engineering Division

333 S. Meridian, Puyallup, WA 98371 (253) 864-4165 www.cityofpuyallup.org

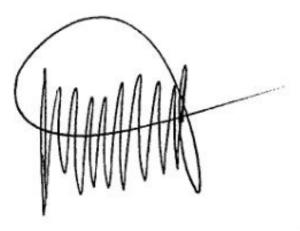

Jason Little
Development Engineering Inspector
JLittle@PuyallupWA.gov
(253) 244-0387