

EAST TOWN CROSSING BUILDING 'A'



GENERAL PROJECT NOTES:

- CONTRACTOR SHALL PERFORM ALL WORK WITHIN THIS SCOPE IN ACCORDANCE AND COMPLIANCE WITH ALL RELEVANT, CITY, COUNTY, STATE, AND/OR FEDERAL ORDINANCES, LAWS, REGULATIONS AND CODES. CONTRACTOR SHALL COMPLY WITH ALL REQUIREMENTS ESTABLISHED BY THE 2018 INTERNATIONAL BUILDING CODE (IBC) WITH THE STATE OF WASHINGTON AMENDMENTS.
- THE CONTRACTOR IS RESPONSIBLE FOR FAMILIARIZING HIMSELF WITH THE CONTENT OF THESE DRAWINGS PRIOR TO PROCEEDING WITH THE WORK. DO NOT SCALE THE DRAWINGS.
- IN THE EVENT THE CONTRACTOR FINDS A CONFLICT OR DISCREPANCY WITH THESE DRAWINGS, THE ARCHITECT SHALL BE NOTIFIED IMMEDIATELY IN WRITING. SHOULD THE CONTRACTOR PROCEED WITHOUT NOTIFYING THE ARCHITECT OF SUCH CONFLICT, THE CONTRACTOR SHALL BE PROCEEDING AT HIS OWN RISK & ASSOCIATED LIABILITY.
- THESE DRAWINGS SERVE TO REPRESENT DESIGN INTENT AS DIRECTED BY THE OWNER & COMPLIANT WITH GOVERNING JURISDICTIONAL LAW. IN NO WAY SHALL THESE DRAWINGS SERVE TO DICTATE METHODS OF CONSTRUCTION RELATIVE TO ADHERENCE TO EITHER. IT IS THE CONTRACTOR'S & OWNER'S RESPONSIBILITY TO WORK WITHIN THE PARAMETERS OF THE AGENCY APPROVED DOCUMENTS TO MAINTAIN THE INTEGRITY OF THE DESIGN INTENT AND AGENCY COMPLIANCE. ANY ERRORS, OMISSIONS OR NONCOMPLIANCE WITH GOVERNING CODES SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT IMMEDIATELY.
- CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND SITE CONDITIONS BEFORE STARTING WORK. THE ENGINEER SHALL BE NOTIFIED OF ANY DISCREPANCY. CHANGES, OMISSIONS OR SUBSTITUTIONS ARE NOT PERMITTED WITHOUT WRITTEN APPROVAL OF THE ENGINEER.
- THE DESIGN, ADEQUACY AND SAFETY OF ERECTION BRACING, SHORING, TEMPORARY SUPPORTS, ETC., IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR, AND HAS NOT BEEN CONSIDERED BY THE ENGINEER. THE CONTRACTOR IS RESPONSIBLE FOR THE STABILITY OF THE STRUCTURE PRIOR TO THE COMPLETION OF ALL SHEAR WALLS, ROOF AND FLOOR DIAPHRAGMS AND FINISHED MATERIALS. THE CONTRACTOR SHALL PROVIDE THE NECESSARY BRACING TO PROVIDE STABILITY PRIOR TO THE APPLICATION OF THE ABOVE MENTIONED COMPONENTS.
- CONTRACTOR SHALL MAINTAIN THE JOBSITE IN A CLEAN AND PROFESSIONAL CONDITION. ANY DEBRIS GENERATED DURING CONSTRUCTION SHALL BE REMOVED FROM THE LOCAL JOBSITE CONTINUALLY. LOCAL JOBSITES SHALL BE LEFT IN A CLEAN AND NEAT CONDITION AT THE END OF EACH WORKDAY. DEBRIS REMOVAL FROM THE JOBSITE SHALL BE ONGOING. CONTRACTOR SHALL DISPOSE ALL MATERIALS AND DEBRIS IN A LEGAL MANNER. ALL PEDESTRIAN AND VEHICULAR ACCESS-WAYS SHALL BE MAINTAINED IN A CLEAN CONDITION THROUGHOUT THE PROJECT.
- SPECIAL INSPECTION SHALL BE PROVIDED BY AND INDEPENDENT TESTING LABORATORY PER THE REQUIREMENTS OF IBC CHAPTER 17 AND THE LOCAL BUILDING OFFICIAL OR APPLICABLE JURISDICTION AND CONTRACT DOCUMENTS. THE SPECIAL INSPECTOR SHALL SUBMIT INSPECTION REPORTS AND A FINAL SIGNED REPORT TO THE BUILDING OFFICIAL FOR THE ITEMS LISTED IN THE QUALITY ASSURANCE/SPECIAL INSPECTION SECTION:
- THE CONTRACTOR SHALL VERIFY THE DIMENSIONS REQUIRED FOR ALL EQUIPMENT, APPLIANCES, FIXTURES, CABINETS, DUCTWORK AND OPENINGS BEFORE FRAMING BEGINS. THE CONTRACTOR SHALL COORDINATE WITH THE SUBCONTRACTORS OF ALL TRADES TO VERIFY THE SIZES AND LOCATIONS OF OPENINGS THROUGH THE FLOORS, WALLS, CEILINGS AND ROOFS FOR DUCTS, PIPES, CONDUITS AND EQUIPMENT. THE CONTRACTOR SHALL COORDINATE THE LOCATION AND INSTALLATION OF WOOD BACKING, BLOCKING, FURRING AND STRIPPING AS REQUIRED FOR THE INSTALLATION AND ATTACHMENT OF WORK OF ALL TRADES.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE SYSTEMS, INCLUDING, BUT NOT LIMITED TO, MECHANICAL, PLUMBING, ELECTRICAL WORK. WORK SHOWN IN THE DRAWINGS IS INTENDED TO ILLUSTRATE THE GENERAL DESIGN INTENT, SCOPE AND LOCATION OF WORK. ALL WORK NOT SPECIFICALLY DRAWN, BUT REQUIRED FOR A COMPLETE, LEGAL AND FUNCTIONING SYSTEM, SHALL BE PROVIDED AS PART OF THE WORK.

ABBREVIATIONS

A.F.F.	ABOVE FINISH FLOOR
A.S.F.	ABOVE SUBFLOOR
ABC	AGGREGATE BASE COURSE
ADJ.	ADJUSTABLE
ALUM	ALUMINUM
BD	BOARD
CPT	CARPET
CLG.	CEILING
☐	CENTERLINE
CLR.	CLEAR
CLO.	CLOSET
COL.	COLUMN
CONC.	CONCRETE
CONT.	CONTINUOUS
DTL.	DETAIL
DW	DISH WASHER
D	DRYER
DBL.	DOUBLE
DN	DOWN
D.S.	DOWNSPOUT
EQ.	EQUAL
EQUIP.	EQUIPMENT
E.T.R.	EXISTING TO REMAIN
EXT.	EXTERIOR
F.D.	FLOOR DRAIN
F.O.E.W.	FACE OF EXISTING WALL
F.O.S.	FACE OF STUD
F.O.S.W.	FACE OF STEM WALL
GWB	GYPSON WALL BOARD
HT.	HEIGHT
INSTAL.	INSTALLATION
MFR.	MANUFACTURER
MTL.	METAL
MTR.	MATERIAL
MIN.	MINIMUM
N.T.S.	NOT TO SCALE
O.C.	ON CENTER
O.T.S.	OPEN TO STRUCTURE
PDC	PEDESTRIAN DECK COATING
P-LAM	PLASTIC LAMINATE
PR	PAIR
PT	PAINT
P.T.	PRESSURE TREATED
PWD	PLYWOOD
R	RANGE
REF.	REFRIGERATOR
REINF.	REINFORCED
RB	RUBBER BASE
SLR	SEALER
SIM.	SIMILAR
SF	SQUARE FEET
SG	SAFETY GLAZING
STL.	STEEL
STRUCT.	STRUCTURAL
TEXT	TEXTURE
TL	TILE
T & G	TONGUE & GROOVE
T.O.W.	TOP OF WALL
TYP.	TYPICAL
U.N.O.	UNLESS NOTED OTHERWISE
WC	WATER CLOSET
WH	WATER HEATER
WD	WOOD
W	WASHER
W/	WITH
WR	WATER RESISTANT

TABLE OF CONTENTS

ARCHITECTURAL

AG1.0	COVER SHEET
AG1.1	BUILDING INFORMATION
AG1.2	LAND USE & WSEC INFORMATION
AG1.3	PROJECT INFORMATION
AG1.4	ASSEMBLY TYPES
AG1.5	ASSEMBLY REFERENCES
AG1.6	ACCESSIBLE ENTRANCES
AG1.7	CODE DIAGRAMS
A1.0	LEVEL 1 FLOOR PLAN
A1.1	LEVEL 2 FLOOR PLAN
A1.2	LEVEL 3 FLOOR PLAN
A1.3	ROOF PLAN
A1.4	LEVEL 1 - REFLECTED CEILING PLAN
A1.5	LEVEL 2 - REFLECTED CEILING PLAN
A1.6	LEVEL 3 - REFLECTED CEILING PLAN
A2.0	BUILDING ELEVATIONS
A2.1	BUILDING ELEVATIONS
A3.0	BUILDING SECTIONS
A3.1	BUILDING SECTIONS
A3.2	BUILDING SECTIONS
A3.3	BUILDING SECTIONS
A3.4	BUILDING SECTIONS
A3.5	BUILDING SECTIONS
A3.6	BUILDING SECTIONS
A3.7	BUILDING SECTIONS
A3.8	BUILDING SECTIONS
A4.0	DOORS & WINDOWS
A5.0	INTERIOR ELEVATIONS
A5.1	INTERIOR ELEVATIONS
A6.0	DETAILS
A6.1	DETAILS
A6.2	DETAILS
A6.3	DETAILS
A6.4	DETAILS
A6.5	DETAILS
A6.6	DETAILS
A6.7	DETAILS
A6.8	NOT USED
A6.9	DETAILS

STRUCTURAL

S1.0	STRUCTURAL NOTES
S3.1	FOUNDATION
S3.2	LEVEL 2 FLOOR FRAMING
S3.3	LEVEL 3 FLOOR FRAMING
S3.4	ROOF FRAMING
S3.5	UPPER ROOF FRAMING
S3.6	SHEAR WALL PLAN
S3.7	SHEAR WALL PLAN
S3.8	SHEAR WALL PLAN
S3.9	SHEAR WALL PLAN
S4.1	DETAILS
S4.2	DETAILS
S4.3	DETAILS
S4.4	DETAILS

MECHANICAL

M0.0	LEGENDS, GENERAL NOTES & INDEX
M0.1	PROJECT NOTES
M0.2	TABLES & CALCULATIONS
M0.3	SCHEDULES
M0.4	WSEC FORMS
M1.0	SITE PLAN
M2.0	HVAC PLAN - LEVEL 1
M2.1	HVAC PLAN - LEVEL 2
M2.3	HVAC PLAN - LEVEL 3 & ROOF
M3.0	HVAC ENLARGED PLANS
M4.0	DETAILS & DIAGRAMS
M4.1	DETAILS & DIAGRAMS

ELECTRICAL

E0.00	LEGEND, NOTES, INDEX
E0.02	SITE POWER PLAN
E0.03	SITE LIGHTING PLAN
E1.01	LIGHTING PLAN - LEVEL 1
E1.02	LIGHTING PLAN - LEVEL 2
E1.03	LIGHTING PLAN - LEVEL 3
E1.10	PHOTOMETRIC PLAN - LEVEL 1
E1.50	LIGHTING NOTES & LUMINAIRE SCHEDULE
E3.00	POWER PLAN - LEVEL 1
E3.01	POWER PLAN - LEVEL 2
E3.02	POWER PLAN - LEVEL 3
E3.03	POWER PLAN - ROOF
E5.00	UNIT PLAN NOTES
E5.01	UNIT PLANS
E6.00	ONE-LINE DIAGRAM & PANEL SCHEDULE
E6.01	PANEL SCHEDULES

PLUMBING

P0.00	LEGEND, NOTES & DRAWING INDEX
P0.01	NOTES, TABLES AND CODES
P0.02	FIXTURE UNIT COUNTS AND FIXTURE / DRAIN SCHEDULES
P0.03	EQUIPMENT SCHEDULES, PIPE SIZING, PRESSURE CALCS
P2.0	UNDERSLAB AND LEVEL 1 PLANS
P2.1	LEVEL 1 AND LEVEL 2 PLANS
P2.2	ROOF PLUMBING PLAN
P3.00	ENLARGED UNIT PLANS
P3.01	ENLARGED UNIT PLANS
P4.00	DETAILS
P4.01	DETAILS
P4.02	DETAILS
P6.0	WASTE DIAGRAMS
P6.1	WASTE DIAGRAMS

PROJECT TEAM

OWNER'S:

ASH DEVELOPMENT, LLC
PUYALLUP, WA
c/o: GREG HELLE
253-318-5711
greg.helle@absherco.com

ARCHITECT:

SYNTHESIS 9, LLC
TACOMA, WA
c/o: BRETT LINDSAY
253-468-4117
blindsay@synthesis9.com

CIVIL ENGINEER:

AHBL, INC.
TACOMA, WA
c/o: TODD SAWIN
253-383-2422
tsawin@AHBL.com

STRUCTURAL ENGINEER:

PIERUCCIONI E&C., LLC
TACOMA, WA
c/o: CHON PIERUCCINI
206-949-7866
pieruccioniengineering@gmail.com

LANDSCAPE ARCHITECT:

LYON LANDSCAPE ARCHITECTS
c/o: ERIC J. WILLIAMS
TACOMA, WA
253-678-4173
eric@lyonla.com

PLUMBING & MECHANICAL & LIGHTING

ROBISON ENGINEERING INC.
19401 40TH AVE. W, SUITE 302
LYNNWOOD, WA 98036
c/o: JON ROBISON
206-364-3343
jrobison@robisonengineering.com

FIRE SPRINKLERS

SPRINX FIRE PROTECTION, INC.
c/o: JOE FAULKNER
253-853-7780
joe@sprinxfire.com

BUILDING ENCLOSURE NOTE:

THE BUILDING ENCLOSURE DOCUMENTATION WITHIN THIS DRAWING SET SATISFIES THE REQUIREMENTS OF RCW 64.55.005 THROUGH 64.55.090. NOTE THAT A THIRD PARTY QUALIFIED INSPECTOR OR THE ARCHITECT WHO APPROVED THE BUILDING ENCLOSURE DESIGN SHALL INSPECT THE BUILDING ENCLOSURE DURING THE COURSE OF CONSTRUCTION FOR COMPLIANCE WITH THE BUILDING ENCLOSURE DESIGN DOCUMENTS. NOTE THAT UPON COMPLETION OF THE INSPECTIONS, THE QUALIFIED INSPECTOR SHALL SUBMIT A SIGNED LETTER OF CERTIFICATION TO THE CITY OF PUYALLUP REGARDING THE INSPECTION AND SUBSTANTIAL COMPLIANCE OF THE BUILDING CONSTRUCTION WITH THE BUILDING ENCLOSURE DESIGN DOCUMENTS. NOTE THAT IT IS THE CONTRACTORS RESPONSIBILITY TO ENSURE THAT THE INSPECTOR IS NOTIFIED FOR REGULAR INSPECTIONS OF THE BUILDING ENCLOSURE INSTALLATION.

SYMBOL LEGEND

DETAIL SYMBOL

1	DETAIL NO. OR LETTER
A2.0	SHEET

SECTION SYMBOL

1	DETAIL NO. OR LETTER
A2.0	SHEET

INTERIOR ELEVATION SYMBOL

2	SPECIFIC DETAIL NO.
A4.0	DRAWING NUMBER
4	SHEET

DOOR I.D. SYMBOL

100A	DOOR NUMBER
	REFER TO SHEET A4.0.

ROOM I.D. SYMBOL

ROOM	ROOM NAME
100	ROOM NUMBER

WALL TYPE SYMBOL

1A	WALL TYPE NO.
	REFER TO SHEET AG1.4

FLOOR / CEILING / ROOF ASSEMBLY TYPE SYMBOL

Z#	ASSEMBLY TYPE NO.
	REFER TO SHEET AG1.4

EXTERIOR WINDOW TYPE SYMBOL

#	WINDOW TYPE LETTER
---	--------------------

BUILDING REFERENCE NOTE SYMBOL

#	WINDOW TYPE LETTER
---	--------------------



PROJECT LOCATION

VICINITY MAP (NOT TO SCALE)





The applicant shall request a sediment control and erosion inspection with a City Engineering Inspector through the CityView portal at least 48 hours in advance of job start. Refer to the Stormwater Fact Sheet and City Standards 02.03.02 & 05.02.01

Sediment control and erosion procedures shall be practiced eliminating and preventing off site damage. Stormwater runoff originating upgrade of exposed areas shall be controlled to reduce erosion and sediment loss during the period of exposure. See civil permit PRCCP20230970 for specifications

Roof downspout control is required. Steps shall be taken to prevent drainage onto adjacent lots. See civil permit PRCCP20230970 for specifications

Call Before You Dig. It's the law. Locate all utilities prior to starting work. Dial 811 or call 1-800-424-5555.



The approved construction plans, documents, and all engineering must be posted on the job at all inspections in a visible and readily accessible location.

Full sized legible color plans are required to be provided by the permittee on site for inspection.

Approval of submitted plans is not an approval of omissions or oversights by this office or non compliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable codes and regulations of the local government.



SYNTHESIS 9, LLC
6214 D ST
TACOMA, WA 98403

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE ORIGINAL DESIGN INCORPORATED HEREIN AS PERMITS OF PROFESSIONAL SERVICE ARE THE PROPERTY OF SYNTHESIS 9, LLC AND ARE NOT TO BE USED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN AUTHORIZATION OF SYNTHESIS 9, LLC.



PRGA20250487

EAST TOWN CROSSING
BUILDING 'A'
3002 E PIONEER WAY PUYALLUP WA 98372

REVISIONS

01	RESPONSE TO 1st REVIEW: 2025.08.05
02	RESPONSE TO 2nd REVIEW: 2025.07.31

REVISIONS

DRAWN BY: BL / CM

CHECKED BY: BL

DATE: 25.08.29

TITLE: COVER SHEET

PROJECT #: 2016

SHEET:

AG1.0

AGENCY REVIEW - REVISION No.2 | 25.08.29

BUILDING SUMMARY

PHASE 2 - BUILDING A

DESCRIPTION: 10 UNIT APARTMENT BUILDING
 APPLICABLE BUILDING CODE: 2018 IBC
 OCCUPANCY: R2
 TYPE OF CONSTRUCTION: VB

FIRE SPRINKLERS: YES, NFPA 13R PER 903.3.1.2
 **REQ'D AT DECK & DECK STORAGE

FIRE ALARM SYSTEM AND SMOKE ALARM: YES
 ELEVATOR: NO
 NUMBER OF APARTMENT UNITS: 10 (PER BUILDING)

NUMBER OF (2) BEDROOMS = 10

ACCESSIBLE TYPE A UNITS REQUIRED: 1
 ACCESSIBLE TYPE 'B' UNITS REQUIRED: 3

BASE ALLOWABLE BUILDING AREAS, HEIGHT AND STORIES:
 ALLOWABLE AREA: 7,000-sf
 ALLOWABLE MAXIMUM HEIGHT: 60-ft
 ALLOWABLE STORIES: 3

MODIFICATIONS TO THE BASE ALLOWABLE AREA BUILDING G:
 MODIFICATIONS NOT NECESSARY

**FOR SINGLE-OCCUPANCY, MULTI-STORY BUILDING
 **SEE FRONTAGE CALCULATION FOR AREA INCREASE ON SHEET #AG1.2

PROPOSED HEIGHT: 36-ft MAX. PER PMC
 PROPOSED STORIES: 3

TOTAL PROPOSED GROSS AREA ALL LEVELS:
 (INCLUDES DECKS)

LEVEL 1:	3,998-sf
LEVEL 2:	3,998-sf
LEVEL 3:	2,299-sf
TOTAL:	10,295-sf

OCCUPANT LOAD:
 OCCUPANT LOAD FACTOR: 200 GROSS
 OCCUPANT LOAD PER FLOOR:

LEVEL 1:	20
LEVEL 2:	20
LEVEL 3:	15

PHASE 1 - BUILDING B

DESCRIPTION: 24 APARTMENT UNIT BUILDING
 APPLICABLE BUILDING CODE: 2018 IBC
 OCCUPANCY: R2
 TYPE OF CONSTRUCTION: VB

FIRE SPRINKLERS: YES, NFPA 13R PER 903.3.1.2
 **REQ'D AT DECK & DECK STORAGE

FIRE ALARM SYSTEM AND SMOKE ALARM: YES
 ELEVATOR: NO

NUMBER OF APARTMENT UNITS: 24
 NUMBER OF (1) BEDROOMS = 0
 NUMBER OF (2) BEDROOMS = 12
 NUMBER OF (3) BEDROOMS = 12

ACCESSIBLE TYPE A UNITS REQUIRED: 1
 ACCESSIBLE TYPE A UNITS PROVIDED: 4
 ACCESSIBLE TYPE 'B' UNITS REQUIRED: 7
 ACCESSIBLE TYPE 'B' UNITS PROVIDED: 4

BASE ALLOWABLE BUILDING AREAS, HEIGHT AND STORIES:
 ALLOWABLE AREA: 7,000-sf
 ALLOWABLE MAXIMUM HEIGHT: 60-ft
 ALLOWABLE STORIES: 3

MODIFICATIONS TO THE BASE ALLOWABLE AREA BUILDING B:
 MODIFICATIONS NOT NECESSARY

**FOR SINGLE-OCCUPANCY, MULTI-STORY BUILDING
 **SEE FRONTAGE CALCULATION FOR AREA INCREASE ON SHEET #AG1.2

PROPOSED HEIGHT: 36-ft MAX. PER PMC
 PROPOSED STORIES: 3

TOTAL PROPOSED GROSS AREA ALL LEVELS:
 (INCLUDES COVERED DECKS)

LEVEL 1:	10,572-sf
LEVEL 2:	10,571-sf
LEVEL 3:	10,297-sf
TOTAL:	31,440-sf

OCCUPANT LOAD:
 OCCUPANT LOAD FACTOR: 200 GROSS
 OCCUPANT LOAD PER FLOOR:

LEVEL 1:	50
LEVEL 2:	50
LEVEL 3:	50

PHASE 1 - BUILDING C

DESCRIPTION: 24 APARTMENT UNIT BUILDING
 APPLICABLE BUILDING CODE: 2018 IBC
 OCCUPANCY: R2
 TYPE OF CONSTRUCTION: VB

FIRE SPRINKLERS: YES, NFPA 13R PER 903.3.1.2
 **REQ'D AT DECK & DECK STORAGE

FIRE ALARM SYSTEM AND SMOKE ALARM: YES
 ELEVATOR: NO

NUMBER OF APARTMENT UNITS: 24
 NUMBER OF (1) BEDROOMS = 0
 NUMBER OF (2) BEDROOMS = 12
 NUMBER OF (3) BEDROOMS = 12

ACCESSIBLE TYPE A UNITS REQUIRED: 1
 ACCESSIBLE TYPE 'B' UNITS REQUIRED: 7

BASE ALLOWABLE BUILDING AREAS, HEIGHT AND STORIES:
 ALLOWABLE AREA: 7,000-sf
 ALLOWABLE MAXIMUM HEIGHT: 60-ft
 ALLOWABLE STORIES: 3

MODIFICATIONS TO THE BASE ALLOWABLE AREA BUILDING C:
 MODIFICATIONS NOT NECESSARY

**FOR SINGLE-OCCUPANCY, MULTI-STORY BUILDING
 **SEE FRONTAGE CALCULATION FOR AREA INCREASE ON SHEET #AG1.2

PROPOSED HEIGHT: 36-ft MAX. PER PMC
 PROPOSED STORIES: 3

TOTAL PROPOSED GROSS AREA ALL LEVELS:
 (INCLUDES COVERED DECKS)

LEVEL 1:	10,563-sf
LEVEL 2:	10,574-sf
LEVEL 3:	10,574-sf
TOTAL:	31,711-sf

OCCUPANT LOAD:
 OCCUPANT LOAD FACTOR: 200 GROSS
 OCCUPANT LOAD PER FLOOR:

LEVEL 1:	50
LEVEL 2:	50
LEVEL 3:	50

PHASE 1 - BUILDING D

DESCRIPTION: 24 APARTMENT UNIT BUILDING
 APPLICABLE BUILDING CODE: 2018 IBC
 OCCUPANCY: R2
 TYPE OF CONSTRUCTION: VB

FIRE SPRINKLERS: YES, NFPA 13R PER 903.3.1.2
 **REQ'D AT DECK & DECK STORAGE

FIRE ALARM SYSTEM AND SMOKE ALARM: YES
 ELEVATOR: NO

NUMBER OF APARTMENT UNITS: 24
 NUMBER OF (1) BEDROOMS = 0
 NUMBER OF (2) BEDROOMS = 12
 NUMBER OF (3) BEDROOMS = 12

ACCESSIBLE TYPE A UNITS REQUIRED: 2
 ACCESSIBLE TYPE 'B' UNITS REQUIRED: 6

BASE ALLOWABLE BUILDING AREAS, HEIGHT AND STORIES:
 ALLOWABLE AREA: 7,000-sf
 ALLOWABLE MAXIMUM HEIGHT: 60-ft
 ALLOWABLE STORIES: 3

MODIFICATIONS TO THE BASE ALLOWABLE AREA BUILDING D:
 MODIFICATIONS NOT NECESSARY

**FOR SINGLE-OCCUPANCY, MULTI-STORY BUILDING
 **SEE FRONTAGE CALCULATION FOR AREA INCREASE ON SHEET #AG1.2

PROPOSED HEIGHT: 36-ft MAX. PER PMC
 PROPOSED STORIES: 3

TOTAL PROPOSED GROSS AREA ALL LEVELS:
 (INCLUDES COVERED DECKS)

LEVEL 1:	10,180-sf
LEVEL 2:	10,164-sf
LEVEL 3:	9,922-sf
TOTAL:	30,266-sf

OCCUPANT LOAD:
 OCCUPANT LOAD FACTOR: 200 GROSS
 OCCUPANT LOAD PER FLOOR:

LEVEL 1:	50
LEVEL 2:	50
LEVEL 3:	50

PHASE 2 - BUILDING E

DESCRIPTION: 24 APARTMENT UNIT BUILDING
 APPLICABLE BUILDING CODE: 2018 IBC
 OCCUPANCY: R2
 TYPE OF CONSTRUCTION: VB

FIRE SPRINKLERS: YES, NFPA 13R PER 903.3.1.2
 **REQ'D AT DECK & DECK STORAGE

ELEVATOR: NO
 NUMBER OF APARTMENT UNITS: 24

NUMBER OF (1) BEDROOMS = 0
 NUMBER OF (2) BEDROOMS = 12
 NUMBER OF (3) BEDROOMS = 12

ACCESSIBLE TYPE A UNITS REQUIRED: 1
 ACCESSIBLE TYPE 'B' UNITS REQUIRED: 7

BASE ALLOWABLE BUILDING AREAS, HEIGHT AND STORIES:
 ALLOWABLE AREA: 7,000-sf
 ALLOWABLE MAXIMUM HEIGHT: 60-ft
 ALLOWABLE STORIES: 3

MODIFICATIONS TO THE BASE ALLOWABLE AREA BUILDING E:
 MODIFICATIONS NOT NECESSARY

**FOR SINGLE-OCCUPANCY, MULTI-STORY BUILDING
 **SEE FRONTAGE CALCULATION FOR AREA INCREASE ON SHEET #AG1.2

PROPOSED HEIGHT: 36-ft MAX. PER PMC
 PROPOSED STORIES: 3

TOTAL PROPOSED GROSS AREA ALL LEVELS:
 (INCLUDES COVERED DECKS)

LEVEL 1:	9,869-sf
LEVEL 2:	10,139-sf
LEVEL 3:	9,922-sf
TOTAL:	29,929-sf

OCCUPANT LOAD:
 OCCUPANT LOAD FACTOR: 200 GROSS
 OCCUPANT LOAD PER FLOOR:

LEVEL 1:	50
LEVEL 2:	50
LEVEL 3:	50

PHASE 2 - BUILDING F

DESCRIPTION: 24 UNIT APARTMENT BUILDING
 APPLICABLE BUILDING CODE: 2018 IBC
 OCCUPANCY: R2
 TYPE OF CONSTRUCTION: VB

FIRE SPRINKLERS: YES, NFPA 13R PER 903.3.1.2
 **REQ'D AT DECK & DECK STORAGE

FIRE ALARM SYSTEM AND SMOKE ALARM: YES
 ELEVATOR: NO

NUMBER OF APARTMENT UNITS: 24 (PER BUILDING)

NUMBER OF (1) BEDROOMS = 12
 NUMBER OF (2) BEDROOMS = 12
 ACCESSIBLE TYPE A UNITS REQUIRED: 2
 ACCESSIBLE TYPE 'B' UNITS REQUIRED: 7

BASE ALLOWABLE BUILDING AREAS, HEIGHT AND STORIES:
 ALLOWABLE AREA: 7,000-sf
 ALLOWABLE MAXIMUM HEIGHT: 60-ft
 ALLOWABLE STORIES: 3

MODIFICATIONS TO THE BASE ALLOWABLE AREA BUILDING F:
 MODIFICATIONS NOT NECESSARY

**FOR SINGLE-OCCUPANCY, MULTI-STORY BUILDING
 **SEE FRONTAGE CALCULATION FOR AREA INCREASE ON SHEET #AG1.2

PROPOSED HEIGHT: 36-ft MAX. PER PMC
 PROPOSED STORIES: 3

TOTAL PROPOSED GROSS AREA ALL LEVELS:
 (INCLUDES COVERED DECKS)

LEVEL 1:	8,681sf
LEVEL 2:	8,642-sf
LEVEL 3:	8,416-sf
TOTAL:	25,739-sf

OCCUPANT LOAD:
 OCCUPANT LOAD FACTOR: 200 GROSS
 OCCUPANT LOAD PER FLOOR:

LEVEL 1:	43
LEVEL 2:	43
LEVEL 3:	42

PHASE 1 - BUILDING G

DESCRIPTION: 24 UNIT APARTMENT BUILDING
 APPLICABLE BUILDING CODE: 2018 IBC
 OCCUPANCY: R2
 TYPE OF CONSTRUCTION: VB

FIRE SPRINKLERS: YES, NFPA 13R PER 903.3.1.2
 **REQ'D AT DECK & DECK STORAGE

FIRE ALARM SYSTEM AND SMOKE ALARM: YES
 ELEVATOR: NO

NUMBER OF APARTMENT UNITS: 24 (PER BUILDING)
 NUMBER OF (1) BEDROOMS = 6
 NUMBER OF (2) BEDROOMS = 18

ACCESSIBLE TYPE A UNITS REQUIRED: 1
 ACCESSIBLE TYPE A UNITS PROVIDED: 4
 ACCESSIBLE TYPE 'B' UNITS REQUIRED: 7
 ACCESSIBLE TYPE 'B' UNITS PROVIDED: 4

BASE ALLOWABLE BUILDING AREAS, HEIGHT AND STORIES:
 ALLOWABLE AREA: 7,000-sf
 ALLOWABLE MAXIMUM HEIGHT: 60-ft
 ALLOWABLE STORIES: 3

MODIFICATIONS TO THE BASE ALLOWABLE AREA BUILDING G:
 MODIFICATIONS NOT NECESSARY

**FOR SINGLE-OCCUPANCY, MULTI-STORY BUILDING
 **SEE FRONTAGE CALCULATION FOR AREA INCREASE ON SHEET #AG1.2

PROPOSED HEIGHT: 36-ft MAX. PER PMC
 PROPOSED STORIES: 3

TOTAL PROPOSED GROSS AREA ALL LEVELS:
 (INCLUDES COVERED DECKS)

LEVEL 1:	7,385-sf
LEVEL 2:	7,359-sf
LEVEL 3:	7,113-sf
TOTAL:	21,857-sf

OCCUPANT LOAD:
 OCCUPANT LOAD FACTOR: 200 GROSS
 OCCUPANT LOAD PER FLOOR:

LEVEL 1:	36
LEVEL 2:	36
LEVEL 3:	35

PHASE 1 - BUILDING H

DESCRIPTION: 24 UNIT APARTMENT BUILDING
 APPLICABLE BUILDING CODE: 2018 IBC
 OCCUPANCY: R2
 TYPE OF CONSTRUCTION: VB

FIRE SPRINKLERS: YES, NFPA 13R PER 903.3.1.2
 **REQ'D AT DECK & DECK STORAGE

FIRE ALARM SYSTEM AND SMOKE ALARM: YES
 ELEVATOR: NO

NUMBER OF APARTMENT UNITS: 24 (PER BUILDING)
 NUMBER OF (1) BEDROOMS = 6
 NUMBER OF (2) BEDROOMS = 18

ACCESSIBLE TYPE A UNITS REQUIRED: 1
 ACCESSIBLE TYPE A UNITS PROVIDED: 4
 ACCESSIBLE TYPE 'B' UNITS REQUIRED: 7
 ACCESSIBLE TYPE 'B' UNITS PROVIDED: 4

BASE ALLOWABLE BUILDING AREAS, HEIGHT AND STORIES:
 ALLOWABLE AREA: 7,000-sf
 ALLOWABLE MAXIMUM HEIGHT: 60-ft
 ALLOWABLE STORIES: 3

MODIFICATIONS TO THE BASE ALLOWABLE AREA BUILDING H:
 MODIFICATIONS NOT NECESSARY

**FOR SINGLE-OCCUPANCY, MULTI-STORY BUILDING
 **SEE FRONTAGE CALCULATION FOR AREA INCREASE ON SHEET #AG1.2

PROPOSED HEIGHT: 36-ft MAX. PER PMC
 PROPOSED STORIES: 3

TOTAL PROPOSED GROSS AREA ALL LEVELS:
 (INCLUDES COVERED DECKS)

LEVEL 1:	7,822-sf
LEVEL 2:	7,823-sf
LEVEL 3:	7,823-sf
TOTAL:	23,468-sf

OCCUPANT LOAD:
 OCCUPANT LOAD FACTOR: 200 GROSS
 OCCUPANT LOAD PER FLOOR:

LEVEL 1 EXERCISE:	(50 gross)
LEVEL 1 UNCONCENTRATED ASSEMBLY:	(15 net)
LEVEL 1 ACCESSORY:	(300 gross)
LEVEL 2 RESIDENTIAL:	(220 gross)

PHASE 2 - CLUBHOUSE

DESCRIPTION: 2 ROOM APARTMENT WITH LEASING OFFICE AND MISC. AMENITY SPACES

APPLICABLE BUILDING CODE: 2021 IBC
 FIRE SPRINKLERS: YES; PER IBC 903.3.1.1
 NFPA

FIRE ALARM SYSTEM AND SMOKE ALARM: YES PER 2021 IBC, SECTION 907.2.11.2

OCCUPANCY: LEVEL 1 = A-3 / B
 LEVEL 2 = R-3

TYPE OF CONSTRUCTION: VB
 NUMBER OF APARTMENT UNITS: 1
 ACCESSIBLE UNITS REQUIRED: N/A

BASE ALLOWABLE BUILDING AREAS, HEIGHT AND STORIES:

NON-SEPARATED USE - MOST RESTRICTIVE APPLIES
 ALLOWABLE AREA PER FLOOR:
 LEVEL 1: B, NS = 9,000 sq ft

LEVEL 2: R-3, NS = UL
 ALLOWABLE MAXIMUM HEIGHT:
 B, NS = 40-FT
 R, NS = 40-FT

ALLOWABLE STORIES:
 B, NS = 2
 R-3, NS = 3

TOTAL PROPOSED GROSS AREA ALL LEVELS:

LEVEL 1 AMENITY:	2,507-sf
LEVEL 2 RESIDENCE:	1,200-sf
TOTAL:	3,707-sf

LEVEL 2 DECK: 191-sf

APARTMENT UNIT TO HAVE EMERGENCY ESCAPE AND RESCUE OPENINGS

APARTMENTS BUILDING EGRESS

NUMBER OF EXITS REQUIRED PER FLOOR: 2
 EACH EXIT SERVING NO MORE THAN FOUR UNITS PER TABLE 1006.3.2(1)
 NUMBER OF EXITS PROPOSED PER FLOOR: 2

MAXIMUM ALLOWED EXIT ACCESS TRAVEL DISTANCE WITH SPRINKLERS: 125-LF

NOTE: PER TABLE 1006.3.2(1), EACH HALF OF THE BUILDING IS CONSIDERED A SINGLE EXIT SPACE REQUIRING EACH APARTMENT UNIT TO HAVE EMERGENCY ESCAPE AND RESCUE OPENINGS IN ACCORDANCE WITH SECTION 1030 OF 2018 IBC.

FIRE PROTECTION FOR APARTMENT BUILDINGS

FIRE ALARM SYSTEM AND SMOKE ALARM: YES PER 2018 IBC, SECTION 907.2.9

** A MANUAL FIRE ALARM SYSTEM THAT ACTIVATES THE OCCUPANT NOTIFICATION SYSTEM IN ACCORDANCE WITH SECTION 907.5 IS REQUIRED UNLESS THE AUTOMATIC FIRE SPRINKLER SYSTEM IS INSTALLED IN ACCORDANCE WITH SECTION 903.3.1.1 OR 903.3.1.2 AND THE OCCUPANT NOTIFICATION APPLIANCES AUTOMATICALLY ACTIVATE THROUGHOUT THE NOTIFICATION ZONES UPON A SPRINKLER WATERFLOW.

** SMOKE ALARMS SHALL BE INSTALLED AND MAINTAINED ON THE CEILING OR WALL OUTSIDE EACH SEPARATE SLEEPING AREA AND IN EACH ROOM USED FOR SLEEPING PURPOSES.

FIRE SEPARATION BETWEEN APARTMENT DWELLING UNITS: YES PER 2018 IBC SECTION 420, 708 AND 711
 SEPARATION WALLS: 1-HR FIRE PARTITION PER 708.3 2018 IBC
 HORIZONTAL SEPARATION: 1-HR HORIZONTAL ASSEMBLY PER 711.3

FIRE-RESISTANCE RATING REQUIREMENTS FOR BUILDING ELEMENTS PER IBC (2018) TABLES 601 AND 602:

PRIMARY STRUCTURAL FRAME:
 EXTERIOR BEARING WALLS: 0-HR

INTERIOR BEARING WALLS: 0-HR
 NONBEARING EXTERIOR WALL AND PARTITIONS: 0-HR
 NONBEARING INTERIOR WALL AND PARTITIONS: 0-HR
 FLOOR CONSTRUCTION AND ASSOCIATED SECONDARY MEMBERS: 0-HR
 ROOF CONSTRUCTION AND ASSOCIATED SECONDARY MEMBERS: 0-HR

DRAFTSTOPPING REQUIREMENTS PER IBC 718.4.2
 DRAFT-STOPPING SHALL BE PROVIDED IN ATTICS OR OTHER CONCEALED ROOF SPACES OF GROUP R-2 BUILDINGS.
 DRAFTSTOPPING SHALL BE INSTALLED ABOVE, AND IN LINE WITH, SLEEPING UNIT AND DWELLING UNIT SEPARATION WALLS THAT DO NOT EXTEND TO THE UNDERSIDE OF THE ROOF SHEATHING ABOVE.

PRIVATE DECK FLOOR/CEILING ASSEMBLY NOT REQUIRED TO BE RATED PER EXCEPTION 705.2.3.1, EXEMPTION #3 WHICH REQUIRES A SPRINKLER HEAD AT THE DECK AND ONE IN THE DECK STORAGE CLOSET.

PHASE 1 - ACCESSIBLE UNITS

DESCRIPTION: 120 UNITS IN 5 BUILDINGS
 ACCESSIBLE TYPE 'A' UNITS REQUIRED: 5% = 120 X .05 = 6
 REMAINING GROUND LEVEL UNITS SHALL BE TYPE 'B'

BUILDING B: (4) TYPE 'A'
 BUILDING C: (3) TYPE 'A'
 BUILDING D: (4) TYPE 'A'
 BUILDING G: (2) TYPE 'A'
 BUILDING H: (2) TYPE 'A'

TYPE 'A' UNITS PROVIDED: 15 > 6 (COMPLIANT)

PHASE 1 - ACCESSIBLE PARKING

ACCESSIBLE TYPE 'A' UNITS REQUIRED: 259 x 0.02 = 5 (PER 1106.2, FOR GROUP R-2, AT LEAST 2% OF EACH TYPE OF PARKING SPACE PROVIDED SHALL BE ACCESSIBLE.)

NUMBER OF ACCESSIBLE STALLS PROVIDED: 16 ≥ 5 (COMPLIANT WITH EXCESS OF 12 ACCESSIBLE STALLS)

PHASE 2 - ACCESSIBLE UNITS

DESCRIPTION: 59 UNITS IN 3 BUILDINGS
 ACCESSIBLE TYPE 'A' UNITS REQUIRED: 5% = 59 X .05 = 3
 REMAINING GROUND LEVEL UNITS SHALL BE TYPE 'B'

BUILDING A: (2) TYPE 'A'
 BUILDING E: (2) TYPE 'A'
 BUILDING F: (3) TYPE 'A'
 CLUBHOUSE: (9) TYPE 1 **NO GROUND LEVEL UNITS

TYPE 'A' UNITS PROVIDED: 7 > 3 (COMPLIANT)

PHASE 2 - ACCESSIBLE PARKING

ACCESSIBLE TYPE 'A' UNITS REQUIRED: 123 x 0.02 = 3 (PER 1106.2, FOR GROUP R-2, AT LEAST 2% OF EACH TYPE OF PARKING SPACE PROVIDED SHALL BE ACCESSIBLE.)

LAND USE & WSEC INFORMATION

PARCEL SUMMARY

P/N 0420264021:

TAX DESCRIPTION - Section 26 Township 20 Range 04 Quarter 44 - & 35 20 4E D 1/21 BEG INTER S LI SEC 26 WITH E 1/16 LI SD SEC TH S ALG 1/16 LI SEC 35 95.4 FT TH E 258.26 FT TH N TO SLY LI CO RD TH NWLY ALG SD SLY LI CO RD TO E 1/16 LI SEC 26 TH S ALG SD 1/16 LI TO BEG EXC
AREA - 95,396 SF, 2.190 ACRES

P/N 0420351030:

TAX DESCRIPTION - BEG AT 1/16 SEC COR 1321.48 FT W OF COR COM TO SECS 25, 26, 35 & 36 TH S ALG 1/16 LI 95.4 FT TO POB TH E 258.26 FT TH S 100 FT TH W 258.26 FT TH N 100 FT TO POB EXC RDS
AREA - 25,700 SF, 0.590 ACRES

P/N 0420351029:

TAX DESCRIPTION - Section 35 Township 20 Range 04 Quarter 11 : COM 1/16 SEC COR 1321.48 FT W OF COR MON COMMON TO SECS 25, 26, 35 & 36 TH S ALG 1/16 SEC LI 195.4 FT TO POB TH E 258.26 FT TH S 100 FT TH W 258.26 FT TH N 100 FT TO POB EXC RDS EXC SHAW CO RD
AREA - 25,265 SF, 0.58 ACRES

P/N 0420351026:

TAX DESCRIPTION - Section 35 Township 20 Range 04 Quarter 11 : COM AT 1/16 COR 1321.48 FT W OF COR MON COMMON TO SECS 25, 26, 35 & 36 TH S ALG 1/16 SEC LI 295.4 FT TO POB TH E 258.35 FT TH S 100 FT TH W 258.35 FT TH N 100 FT TO POB EXC W 15 FT CO RD EXC SHAW CO RD
AREA - 25,265 SF, 0.58 ACRES

P/N 0420264053:

TAX DESCRIPTION - Section 35 Township 20 Range 04 Quarter 11 Section 26 Township 20 Range 04 Quarter 44 L 4 OF DBLR 2003-03-31-5001 DESC AS FOLL THAT POR OF SE OF SE & NE OF NE OF NE OF SEC 35 DESC AS COM AT NE COR OF W 1/2 OF SD NE OF NE PT BEARS N 88 DEG 32 MIN 51 SEC
AREA - 202,648 SF, 4.652 ACRES

P/N 0420351066:

TAX DESCRIPTION - Section 35 Township 20 Range 04 Quarter 11 L 3 OF DBLR 2003-03-31-5001 DESC AS FOLL THAT POR OF NE OF NE DESC AS COM AT NE COR OF W 1/2 OF NE OF NE PT BEARS N 88 DEG 32 MIN 51 SEC W 640.11 FT FROM MON OF NE COR TH S 01 DEG 15 MIN 04 SEC W 491.43 FT T
AREA - 58,789 SF, 1.35 ACRES

P/N 0420264054:

TAX DESCRIPTION - Section 26 Township 20 Range 04 Quarter 44 L 5 OF DBLR 2003-03-31-5001 DESC AS FOLL THAT POR OF SE OF SE & NE OF NE OF SEC 35 DESC AS BEG AT NE COR OF W 1/2 OF SD NE OF NE PT BEARS N 88 DEG 32 MIN 51 SEC W 640.11 FT FROM MON OF NE COR SD SEC 35 TH S
AREA - 43,335 SF, 0.995 ACRES

W.S.E.C.

BUILDING ENVELOPE REQUIREMENTS

ZONE	4C - MARINE
PATH	PRESCRIPTIVE
ROOFS - ATTIC AND OTHER	R-VALUE = 49
FENESTRATION	U-FACTOR = 0.30
FENESTRATION SHGC	NO REQUIREMENTS
SKYLIGHTS	U-FACTOR = N/A
WOOD FRAMED WALLS	R-VALUE = 21 INT
MASS WALL R-VALUE	N/A
FLOOR	R-VALUE: 30
SLAB, R-VALUE & DEPTH	10, 2-FT

APPLICABLE 2018 WSEC BUILDING ENVELOPE NOTES :

1. AN IDENTIFICATION MARK SHALL BE APPLIED TO ALL INSULATION MATERIALS PER C303.1.
2. ALL FENESTRATION PRODUCTS SHALL BE LABELED WITH RATED U-FACTOR, SHGC, VT, LEAKAGE RATING PER C303.1.3 AND C402.4.3.

REFER TO TABLE R402.4.1.1 OF THE 2018 RESIDENTIAL WSEC FOR AIR BARRIER AND INSULATION INSTALLATION REQUIREMENTS.

ENERGY CREDITS

NOTE: EACH RESIDENCE QUALIFIES AS A SMALL DWELLING UNIT WITH 4.5 CREDITS REQUIRED PER THE 2018 WSEC. THE FOLLOWING CREDITS HAVE BEEN SELECTED.

FUEL NORMALIZATION CREDITS - Option #2 = 1.0

For an initial heating system using a heat pump that meets federal standards for the equipment listed in Table C403.3.2(1)C or C403.3.2(2)

3. HIGH EFFICIENCY HVAC EQUIPMENT OPTIONS = 2.0

3.4 - Ductless mini-split heat pump system, zonal control: In homes where the primary space heating system is zonal electric heating, a ductless mini-split heat pump system with a minimum HSPF of 10.0 shall be installed and provide heating to the largest zone of the housing unit.

5. EFFICIENT WATER HEATING OPTIONS = 2.5

5.5 - For R-2 Occupancy, electric heat pump water heater(s), meeting the standards for Tier III of NEEA's advanced water heating specification, shall supply domestic hot water to all units. If one water heater is serving more than one dwelling unit, all hot water supply and recirculation piping shall be insulated with R-8 minimum pipe insulation.

TOTAL: 5.5 credits

ZONING

DESIGNATION: RM-20, HIGH DENSITY MULTI-FAMILY RESIDENTIAL

USE: DWELLING, MULTIPLE-FAMILY
MINIMUM LOT AREA: 4,000 SF
MINIMUM LOT DIMENSIONS: 40 FT X 70 FT
MINIMUM SETBACKS: 20 FT FRONT, 25 FT MAJOR ARTERIAL, 20 FT REAR, 15 FT SIDE
MAXIMUM HEIGHT: 36 FT
BASE DENSITY: 16 du/ac, BONUS UP TO 22 du/ac (193 units / 8.66 ac = 21.9 du/ac)
MAXIMUM LOT COVERAGE: 55%
MAXIMUM FAR: 3

NUMBER OF BUILDINGS:

PHASE 1: 5
PHASE 2: 4
TOTAL: 9

RESIDENTIAL VEHICLE PARKING ANALYSIS

DIMENSIONS:

STANDARD: 9'-x-20' 8' x 18'
COMPACT: 8'-x-17' 7' x 15'

PHASE 1

PHASE 1 REQUIRED: 2 STALLS PER UNIT = 120 x 2 = 240
PHASE 1 PROVIDED = 240
EXCESS STALLS: 240 - 240 = 0

COMPACT MIN. = 30% OF REQUIRED = 240 x 0.30 = 72
COMPACT MAX. = 50% OF REQUIRED = 240 x 0.50 = 120
COMPACT PROVIDED: 75

PHASE 2

PHASE 2 REQUIRED: 2 STALLS PER UNIT = 59 x 2 = 118
PHASE 2 PROVIDED = 118
EXCESS STALLS: 118 - 118 = 0

COMPACT MIN. = 30% OF REQUIRED = 116 x 0.30 = 35
COMPACT MAX. = 50% OF REQUIRED = 116 x 0.50 = 58
COMPACT STALLS PROVIDED: 32

TOTAL - PHASE 1 & PHASE 2

REQUIRED: 2 STALLS PER UNIT = 179 x 2 = 358
ON-SITE VEHICLE STALLS PROVIDED: 240 + 118 = 358
EXCESS STALLS: 358-358 = 0

COMPACT MIN. = 30% OF REQUIRED = 358 x 0.30 = 107
COMPACT MAX. = 50% OF REQUIRED = 358 x 0.50 = 179
COMPACT STALLS PROVIDED: 135

TOTAL ACCESSIBLE STALL REQUIREMENT

PHASE 1 ACCESSIBLE STALLS
PHASE 1 REQUIRED: 240 x 0.02 = 4
PHASE 1 PROVIDED: 22 > 4 (COMPLIANT)
PHASE 1 VAN REQUIRED: 4 (1 PER EVERY 6 ACCESSIBLE STALLS)
PHASE 1 VAN PROVIDED: 6 > 4

PHASE 2 ACCESSIBLE STALLS

PHASE 2 REQUIRED: 118 x 0.02 = 2
PHASE 2 PROVIDED: 12 > 2
PHASE 2 VAN REQUIRED: 1 (1 PER EVERY 6 ACCESSIBLE STALLS)
PHASE 2 VAN PROVIDED: 4 > 1

TOTAL ACCESSIBLE STALLS

TOTAL REQUIRED: 389 x 0.02 = 8
TOTAL PROVIDED: 34 > 8
PHASE 2 VAN REQUIRED: 4 (1 PER EVERY 6 ACCESSIBLE STALLS)
PHASE 2 VAN PROVIDED: 10 > 4

COMMERCIAL VEHICLE PARKING ANALYSIS

LOT No.1

TENANT IMPROVEMENT SPACE 'T.I.'1' = 3000/100 = 7 REQUIRED
TENANT IMPROVEMENT SPACE 'T.I.'1' = 2000/300 = 30 REQUIRED

Lot No. 2

TENANT IMPROVEMENT SPACE 'T.I..1' = 3885/300 = 39 REQUIRED

LOT 1 TOTAL REQUIRED = 37
LOT 2 TOTAL REQUIRED = 39
TOTAL REQUIRED = 72

PROPOSED PARKING STALLS: 44
STANDARD STALLS: 27
COMPACT STALLS: 15
ADA REQUIRED: 2 (1 VAN)

TOTAL COMMERCIAL PARKING STALLS REQUIRED:76
PROPOSED COMMERCIAL PARKING STALLS REQUIRED

EV CHARGING STATIONS

WAC 51-50-0427 ELECTRIC VEHICLE CHARGING INFRASTRUCTURE:
REQUIRED: 10% of stalls
ADA Required: 10% of required EV charging stalls

PHASE 1 EV CHARGING STATIONS STALLS

PHASE 1 REQUIRED: 240 x 0.10 = 24
PHASE 1 PROVIDED: TOTAL = 24 ≥ 24 (COMPLIANT)

PHASE 1 ADA REQUIRED: 24 x 0.10 = 2
PHASE 1 ADA PROVIDED: 2 ≥ 2 (COMPLIANT)

PHASE 2 EV CHARGING STATIONS STALLS

PHASE 2 REQUIRED: 118 x 0.10 = 12
PHASE 2 PROVIDED: TOTAL = 12 ≥ 12 (COMPLIANT)

PHASE 2 ADA REQUIRED: 12 x 0.10 = 1
PHASE 2 ADA PROVIDED: 5 > 1 (COMPLIANT)

TOTAL PHASE 1 & 2 EV CHARGING STATIONS STALLS

PHASE 1 REQUIRED: 360 x 0.10 = 36
PHASE 1 PROVIDED: TOTAL = 36 ≥ 36 (COMPLIANT)

PHASE 1 ADA REQUIRED: 36 x 0.10 = 4
PHASE 1 ADA PROVIDED: 7 ≥ 4 (COMPLIANT)



SYNTHESIS 9, LLC
824 N. D ST
TACOMA, WA 98403

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE DESIGNATIONS INCORPORATED HEREIN AS INSTRUMENTS OF PROFESSIONAL SERVICE ARE THE PROPERTY OF SYNTHESIS 9, LLC AND ARE NOT TO BE LOANED, REPRODUCED, COPIED, OR IN ANY MANNER THE WRITTEN AUTHORIZATION OF SYNTHESIS 9, LLC.



PRGA20250487



EAST TOWN CROSSING
BUILDING 'A'
3002 E PIONEER WAY PUYALLUP WA 98372

REVISIONS

01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

REVISIONS

DRAWN BY: BL / CM

CHECKED BY: BL

DATE: 25.08.29

TITLE: LAND USE & WSEC INFORMATION

PROJECT #: 2016

SHEET:

AG1.2

EXISTING LOT

BLD'G H FRONTAGE CALCULATION
(TYPE VB W/ NFPA 13R SPRINKLERS)

EQUATION #5-4: MINIMUM FRONTAGE DISTANCE
 $(362 \times 30) / (429) = 25.3$

EQUATION #5-5: AMOUNT OF INCREASE
 $[(362/429 - 0.25) \times 25] / 30 = 0.49$

EQUATION #5-2: SINGLE-OCCUPANCY, MULTISTORY
 $[7,000 + (7,000 \times 0.49)] \times 3$
 $[7,000 + 3,430] \times 3 = 31,290\text{-SF}$

NO STORY SHALL EXCEED
 $[7,000 + (7,000 \times 0.49)] \times 1 = 10,430\text{-SF}$

BLD'G G FRONTAGE CALCULATION
(TYPE VB W/ NFPA 13R SPRINKLERS)

EQUATION #5-4: MINIMUM FRONTAGE DISTANCE
 $(358 \times 30) / (425) = 25$

EQUATION #5-5: AMOUNT OF INCREASE
 $[(358/425 - 0.25) \times 25] / 30 = 0.49$

EQUATION #5-2: SINGLE-OCCUPANCY, MULTISTORY
 $[7,000 + (7,000 \times 0.49)] \times 3$
 $[7,000 + 3,430] \times 3 = 31,290\text{-SF}$

NO STORY SHALL EXCEED
 $[7,000 + (7,000 \times 0.49)] \times 1 = 10,430\text{-SF}$

BLD'G C FRONTAGE CALCULATION
(TYPE VB W/ NFPA 13R SPRINKLERS)

EQUATION #5-4: MINIMUM FRONTAGE DISTANCE
 $(535 \times 30) / (535) = 30$

EQUATION #5-5: AMOUNT OF INCREASE
 $[(535/535 - 0.25) \times 30] / 30 = 0.75$

EQUATION #5-2: SINGLE-OCCUPANCY, MULTISTORY
 $[7,000 + (7,000 \times 0.75)] \times 3$
 $[7,000 + 5,250] \times 3 = 36,750\text{-SF}$

NO STORY SHALL EXCEED
 $[7,000 + (7,000 \times 0.75)] \times 1 = 12,250\text{-SF}$

BLD'G D FRONTAGE CALCULATION
(TYPE VB W/ NFPA 13R SPRINKLERS)

EQUATION #5-4: MINIMUM FRONTAGE DISTANCE
 $(361 \times 30) + (176 \times 20) / (537) = 27$

EQUATION #5-5: AMOUNT OF INCREASE
 $[(537/537 - 0.25) \times 27] / 30 = 0.68$

EQUATION #5-2: SINGLE-OCCUPANCY, MULTISTORY
 $[7,000 + (7,000 \times 0.68)] \times 3$
 $[7,000 + 4,760] \times 3 = 35,280\text{-SF}$

NO STORY SHALL EXCEED
 $[7,000 + (7,000 \times 0.68)] \times 1 = 11,760\text{-SF}$

BLD'G E FRONTAGE CALCULATION
(TYPE VB W/ NFPA 13R SPRINKLERS)

EQUATION #5-4: MINIMUM FRONTAGE DISTANCE
 $(545 \times 30) / (545) = 30$

EQUATION #5-5: AMOUNT OF INCREASE
 $[(545/545 - 0.25) \times 30] / 30 = 0.75$

EQUATION #5-2: SINGLE-OCCUPANCY, MULTISTORY
 $[7,000 + (7,000 \times 0.75)] \times 3$
 $[7,000 + 5,250] \times 3 = 36,750\text{-SF}$

NO STORY SHALL EXCEED
 $[7,000 + (7,000 \times 0.75)] \times 1 = 12,250\text{-SF}$

BLD'G F FRONTAGE CALCULATION
(TYPE VB W/ NFPA 13R SPRINKLERS)

EQUATION #5-4: MINIMUM FRONTAGE DISTANCE
 $(482 \times 30) / (482) = 30$

EQUATION #5-5: AMOUNT OF INCREASE
 $[(482/482 - 0.25) \times 30] / 30 = 0.75$

EQUATION #5-2: SINGLE-OCCUPANCY, MULTISTORY
 $[7,000 + (7,000 \times 0.75)] \times 3$
 $[7,000 + 5,250] \times 3 = 36,750\text{-SF}$

NO STORY SHALL EXCEED
 $[7,000 + (7,000 \times 0.75)] \times 1 = 12,250\text{-SF}$


BLD'G A FRONTAGE CALCULATION
(TYPE VB W/ NFPA 13R SPRINKLERS)

EQUATION #5-4: MINIMUM FRONTAGE DISTANCE
 $(361 \times 30) + (176 \times 20) / (537) = 27$

EQUATION #5-5: AMOUNT OF INCREASE
 $[(537/537 - 0.25) \times 27] / 30 = 0.68$

EQUATION #5-2: SINGLE-OCCUPANCY, MULTISTORY
 $[7,000 + (7,000 \times 0.68)] \times 3$
 $[7,000 + 4,760] \times 3 = 35,280\text{-SF}$

NO STORY SHALL EXCEED
 $[7,000 + (7,000 \times 0.68)] \times 1 = 11,760\text{-SF}$

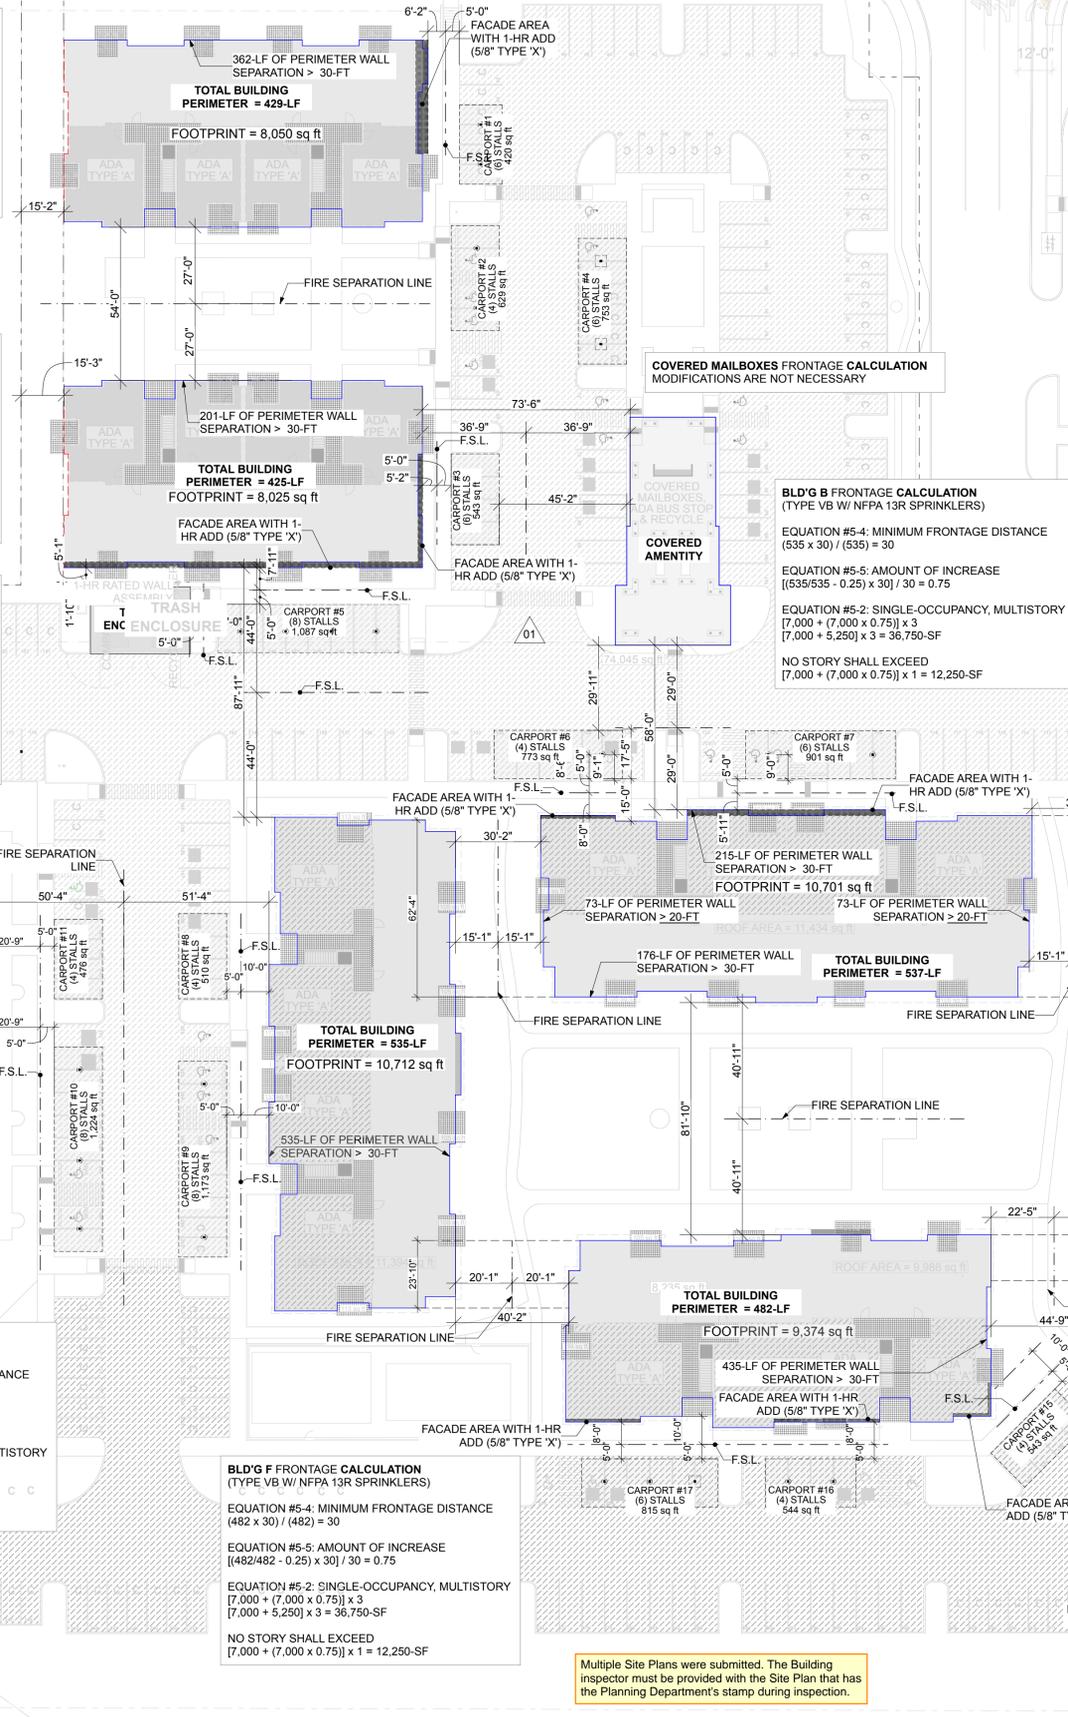

1 FRONTAGE CALCULATIONS
SCALE: 1" = 30'

Multiple Site Plans were submitted. The Building inspector must be provided with the Site Plan that has the Planning Department's stamp during inspection.

LEVEL 3 WALL AREA: 555 sq ft
GLAZING AREA: $(35 \times 2) + 47 + 20 + 6 = 143$
PERCENT OPEN: $143/555 = 24\%$

LEVEL 2 WALL AREA: 622 sq ft
GLAZING AREA: $(35 \times 2) + 47 + 20 + 6 = 143$
PERCENT OPEN: $143/655 = 22\%$

LEVEL 1 WALL AREA: 622 sq ft
GLAZING AREA: $(2 \times 21) + 44 + 6 = 92$
PERCENT OPEN: $92/655 = 22\%$



2 SOUTH ELEVATION TRANSPARENCY
SCALE: 3/32" = 1'-0"

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

REVISIONS	
DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	PROJECT INFORMATION
PROJECT #:	2016
SHEET:	

FLOOR | CEILING | ROOF ASSEMBLIES

- NOTES:**
 1. SEE ASSEMBLY NOTES ON THIS SHEET.
 2. SEE SHEET A6.9 FOR FIRE-STOP PENETRATIONS THROUGH RATED ASSEMBLIES.
 3. SEE ASSEMBLY REFERENCES ON SHEET AG1.5.

<p>Z-1</p> <p>9'-0" A.F.F. 8'-0" A.F.F.</p> <p>MECHANICAL EQUIPMENT</p> <p>1-HR RATED ASSEMBLY</p> <p>DROPPED CEILING</p> <p>NOTE: SEE REFLECTED CEILING PLANS FOR ADDITIONAL DROPPED CEILING AREAS</p>	<p>TYPICAL INTERIOR ASSEMBLY 1-HR FIRE RATED & STC 50 (MINIMUM) ASSEMBLY REFER TO GA FILE No. FC 5112 (PROPRIETARY)</p> <p>FLOOR COVERING PER ASSEMBLY OPTIONS 1 1/4" PROPRIETARY FLOOR TOPPING 1/8" PROPRIETARY SOUND REDUCTION MAT PLYWOOD SHEATHING PER STRUCTURAL FLOOR I-JOISTS PER STRUCTURAL @ 16" O.C. 3-1/2" (MIN.) GLASS FIBER BATTS @ TOP OF CAVITY 1/2" RESILIENT FURRING CHANNELS @ 16" O.C. (RUN PERPENDICULAR TO JOISTS) 5/8" PROPRIETARY TYPE "X" GWB (W.R. IN WET AREAS)</p> <p>* DROPPED CEILING ADD AIR SPACE 2X FRAMING @ 16" O.C. PER STRUCTURAL - TO ACCOMMODATE MECHANICAL EQUIPMENT. 1/2" G.W.B.</p>
<p>Z-2</p>	<p>TYPICAL EXTERIOR ASSEMBLY</p> <p>VINYL PEDESTRIAN DECK COATING SYSTEM; WRAP UP SIDEWALL 8" (MIN.) 3/4" PLYWOOD SHEATHING PER STRUCTURAL (SOLID BLOCK ALL JOINTS FOR DECK COATING) 2 x FLOOR JOISTS PER STRUCTURAL @ 16" O.C. CEMENT BOARD SOFFIT (NOT REQUIRED) (CROSS VENTILATE JOIST CAVITIES IF SOFFITS ARE USED)</p>
<p>Z-2*</p>	<p>TYPICAL EXTERIOR ASSEMBLY</p> <p>2" REGULAR CONCRETE (SLOPE TO DECK EDGE) 60 MIL PVC ROOFING SYSTEM; WRAP UP SIDEWALL 8" (MIN.) 3/4" PLYWOOD SHEATHING PER STRUCTURAL (SOLID BLOCK ALL JOINTS FOR DECK COATING) 2 x FLOOR JOISTS PER STRUCTURAL @ 16" O.C. CEMENT BOARD SOFFIT (NOT REQUIRED) (CROSS VENTILATE JOIST CAVITIES IF SOFFITS ARE USED)</p>
<p>Z-3</p> <p>9'-0" A.F.F. 8'-0" A.F.F.</p> <p>MECHANICAL EQUIPMENT</p> <p>1-HR RATED ASSEMBLY</p> <p>DROPPED CEILING</p> <p>NOTE: SEE REFLECTED CEILING PLANS FOR ADDITIONAL DROPPED CEILING AREAS</p>	<p>TYPICAL ROOF CEILING ASSEMBLY 1-HR FIRE RATED REFER TO GA FILE No. FC RC 2613</p> <p>ROOFING PER ROOF PLAN UNDERLAYMENT PER ROOFING SYSTEM 1/2" SHEATHING PER STRUCTURAL PRE-MFR WOOD TRUSSES PER STRUCTURAL @ 16" O.C. R-49 BATT INSULATION 1/2" RESILIENT FURRING CHANNELS @ 16" O.C. (RUN PERPENDICULAR TO JOISTS) 5/8" PROPRIETARY TYPE "X" GWB (W.R. IN WET AREAS)</p> <p>* DROPPED CEILING ADD AIR SPACE 2X FRAMING @ 16" O.C. PER STRUCTURAL - TO ACCOMMODATE MECHANICAL EQUIPMENT. 1/2" G.W.B.</p>
<p>Z-4</p>	<p>FLOOR / CEILING ASSEMBLY 1-HR FIRE RATED ASSEMBLY REFER TO GA FILE No. FC 5529</p> <p>SINGLE-PLY ROOF MEMBRANE SYSTEM 1/2" PLYWOOD 2x10 JOISTS @ 16" O.C. (2) LAYERS 5/8" W.R., TYPE "X" GWB</p>

WALL ASSEMBLIES

- * SEE ASSEMBLY NOTES ON THIS SHEET & A6.9 FOR FIRE STOP DETAILS AT PENETRATIONS THROUGH RATED ASSEMBLIES.
 ** ON LEVELS 2 AND 3 THERE ARE DOUBLE 2x BASE PLATE WITH GYPSUM UNDERLAYMENT TO THE TOP OF THE FIRST PLATE.

<p>1A</p> <p>NOTE: SEE WALL TYPE & RATED ASSEMBLY NOTE #10 ON THIS SHEET</p>	<p>EXTERIOR WALL FIRE BARRIER 1-HR FIRE RATED ASSEMBLY; REFER TO GA. NO. WP 8105 (SHEET AG1.5)</p> <p>CLADDING WATER RESISTANT BARRIER 5/8" DENSGLOSS 1/2" SHEATHING, WHEN APPLICABLE PER STRUCTURAL 2 X 6 WOOD STUDS @ 16" O.C. WITH R-21 BATT INSULATION 5/8" TYPE "X" GWB (W.R. IN WET AREAS) VAPOR BARRIER PAINT</p>	<p>4F</p> <p>5/8" TYPE "X" GWB (W.R. @ WET AREAS) 2 x 6 WOOD STUDS @ 16" O.C. 5/8" TYPE "X" GWB (W.R. @ WET AREAS)</p>
<p>1A*</p> <p>2 x 4 IN LIEU OF 2 x 6 & INSULATION NOT REQUIRED; OCCURS AT PRIVATE DECKS</p>	<p>EXTERIOR WALL</p> <p>CLADDING WATER RESISTANT BARRIER 1/2" SHEATHING, PER STRUCTURAL 2 X 6 WOOD STUDS @ 16" O.C. WITH R-21 BATT INSULATION 5/8" TYPE "X" GWB (W.R. IN WET AREAS) VAPOR BARRIER PAINT</p>	<p>5A</p> <p>5/8" TYPE "X" GWB (W.R. @ WET AREAS) 2 x 4 WOOD STUDS @ 16" O.C. WITH 3-1/2" SOUND BATTS 5/8" TYPE "X" GWB (W.R. @ WET AREAS)</p>
<p>2A</p>	<p>EXTERIOR WALL</p> <p>CLADDING WATER RESISTANT BARRIER 1/2" SHEATHING, PER STRUCTURAL 2 X 6 WOOD STUDS @ 16" O.C. WITH R-21 BATT INSULATION 5/8" TYPE "X" GWB (W.R. IN WET AREAS) VAPOR BARRIER PAINT</p>	<p>5B</p> <p>5/8" TYPE "X" GWB (W.R. @ WET AREAS) 2 x 4 WOOD STUDS @ 16" O.C. 5/8" TYPE "X" GWB (W.R. @ WET AREAS)</p>
<p>3A</p> <p>NOTE: SEE WALL TYPE & RATED ASSEMBLY NOTE #10 ON THIS SHEET</p>	<p>1-HR FIRE RATED ASSEMBLY REFER TO GA. NO. WP 3605 (SHEET AG1.5)</p> <p>5/8" TYPE "X" GWB (W.R. @ WET AREAS) 2 x 6 WOOD STUDS @ 16" O.C. WITH R-21 BATT INSULATION 5/8" TYPE "X" GWB (W.R. @ WET AREAS)</p>	<p>5C</p> <p>5/8" TYPE "X" GWB (W.R. @ WET AREAS) 1/2" PLYWOOD PER STRUCTURAL 2 x 4 STUDS @ 16" O.C. 5/8" TYPE "X" GWB (W.R. @ WET AREAS)</p>
<p>4A</p> <p>NOTE: SEE WALL TYPE & RATED ASSEMBLY NOTES ON THIS SHEET</p>	<p>APARTMENT UNIT DEMISING WALL FIRE PARTITION 1-HR FIRE RATED & STC 50 (MIN.) ASSEMBLY; REFER TO GA. NO. WP 3242 (SHEET AG1.5)</p> <p>5/8" TYPE "X" GWB (W.R. @ WET AREAS) 1/2" SHEATHING PER STRUCTURAL, WHEN APPLICABLE 2 x 6 WOOD STUDS @ 16" O.C. w/ 5-1/2" SOUND BATTS 1/2" SHEATHING PER STRUCTURAL, WHEN APPLICABLE 5/8" TYPE "X" GWB (W.R. @ WET AREAS)</p>	<p>6A</p> <p>APARTMENT UNIT SIDE STAIR SIDE</p> <p>1-HR FIRE RATED & STC 50 (MIN.) ASSEMBLY; REFER TO GA. NO. WP 3241, 3242 or 3243 (SHEET AG1.5)</p> <p>5/8" TYPE "X" GWB (W.R. @ WET AREAS) 1/2" RESILIENT FURRING CHANNELS @ 16" O.C. 2 x 4 WOOD STUDS @ 16" O.C. WITH 3-1/2" ROCK WOOL 5/8" TYPE "X" GWB (W.R. @ WET AREAS)</p>
<p>4D</p> <p>NOTE: SEE WALL TYPE & RATED ASSEMBLY NOTES ON THIS SHEET</p>	<p>APARTMENT UNIT DEMISING WALL FIRE PARTITION 1-HR FIRE-RATED ASSEMBLY W/ STC 50 OR BETTER REFER TO GA. NO. WP 5512 (SHEET AG1.5)</p> <p>5/8" TYPE "X" GWB (W.R. @ WET AREAS) 5-1/2" ROCK WOOL OR SOUND BATTS 2 x 6 WOOD STUDS @ 24" O.C. 1/2" AIR SPACE 2 x 6 WOOD STUDS @ 24" O.C. 5-1/2" ROCK WOOL OR SOUND BATTS 5/8" TYPE "X" GWB (W.R. @ WET AREAS)</p>	<p>7A</p> <p>OTHER PROPOSED WALL SIDE APARTMENT UNIT SIDE</p> <p>INTERIOR PLUMBING WALL FURRING ADDED TO PROPOSED WALL</p> <p>OTHER PROPOSED WALL AIR SPACE; SEPARATE AS NECESSARY 2 x 4 WOOD STUDS @ 16" O.C. WITH 3-1/2" ROCK WOOL 5/8" TYPE "X" GWB (W.R. @ WET AREAS)</p>
<p>4E</p>	<p>5/8" TYPE "X" GWB (W.R. @ WET AREAS) 2 x 6 WOOD STUDS @ 16" O.C. WITH 5-1/2" SOUND BATTS 5/8" TYPE "X" GWB (W.R. @ WET AREAS)</p>	<p>7B</p> <p>OTHER PROPOSED WALL SIDE</p> <p>INTERIOR WALL FURRING ADDED TO PROPOSED WALL</p> <p>OTHER PROPOSED WALL AIR SPACE; SEPARATE AS NECESSARY 2 x 4 WOOD STUDS @ 16" O.C.; LAY FLAT OR RIP AS NEEDED 5/8" TYPE "X" GWB (W.R. @ WET AREAS)</p>

ASSEMBLY NOTES

- WALLS, PARTITIONS AND FLOOR/CEILING ASSEMBLIES ENCLOSING THE APARTMENT UNITS SHALL HAVE A SOUND TRANSMISSION CLASS (STC) OF NOT LESS THAT 50 FOR AIRBORNE NOISE WHEN TESTED IN ACCORDANCE WITH ASTM E90. PENETRATIONS OR OPENINGS IN CONSTRUCTION ASSEMBLIES FOR PIPING, ELECTRICAL DEVICES, RECESSED CABINETS, BATHUBS SOFFITS OR HEATING, VENTILATING OR EXHAUST DUCTS SHALL BE SEALED, LINED, INSULATED OR OTHERWISE TREATED TO MAINTAIN THE REQUIRED STC. UNIT ENTRY DOORS SHALL BE TIGHT-FITTING TO THE FRAME AND SILL.
- REFER TO THE "FIRE-RESISTANCE-RATED CONSTRUCTION NOTES ON SHEET #AG1.2.
- REFER TO THE "FIRE RATED ASSEMBLY" DIAGRAM ON SHEET #AG1.2 FOR INFORMATION ON WHICH WALLS ARE SPECIFICALLY REQUIRED TO HAVE A FIRE-RATING. AS NOTED IN THAT DIAGRAM, NOT ALL WALLS ARE REQUIRED TO HAVE A FIRE RATING EVEN THOUGH THE WALL TYPE ASSEMBLY HAS THE SAME GENERAL CONFIGURATION OF SURFACES.
- ELECTRICAL OUTLET BOXES SHALL NOT BE PLACED BACK-TO-BACK AND SHALL BE OFFSET BY NOT LESS THAN 12-INCHES FROM OUTLETS IN THE OPPOSITE WALL SURFACE. THE BACK AND THE SIDES OF BOXES SHALL BE SEALED WITH 1/8-INCH RESILIENT SEALANT AND BACKED BY AT LEAST 2-INCH THICK MATERIAL FIBER INSULATION PER IBC 1207.3.
- SPACES OR SHAFTS CONTAINING VENTILATING EQUIPMENT OR OTHER MECHANICAL EQUIPMENT SHALL BE SEPARATED BOTH VERTICALLY AND HORIZONTALLY FROM THE ADJOINING DWELLING UNIT BY CONSTRUCTION DESIGNED TO PROVIDE A MINIMUM STC RATING OF 50.
- DESIGN AND MATERIALS FOR SOUND TRANSMISSION CONTROL SHALL NOT IMPAIR THE FIRE-RESISTANT INTEGRITY OF SEPARATING WALLS OR FLOOR/CEILING ASSEMBLIES.
- WRAP ALL PLUMBING PIPE WITH SOUND ATTENUATION BATTS.
- ROOF ASSEMBLIES TO INCLUDE CLASS C ROOF COVERING THROUGHOUT AND FIRE-RETARDANT-TREATED WOOD SHEATHING FOR A DISTANCE OF 4 FEET OF THE EXTERIOR WALL.
- IN GENERAL, THE CONTRACTOR SHALL REVIEW SECTION 1, GENERAL EXPLANATORY NOTES OF THE GYPSUM ASSOCIATION - 600 - 2009 FIRE RESISTANCE DESIGN MANUAL (19TH EDITION) OR LATER.
- PER IBC 718.2.2 FIRE-BLOCKING SHALL BE PROVIDED IN ALL FURRED SPACES: VERTICALLY AT CEILING AND FLOOR LEVELS, AND HORIZONTALLY AT INTERVALS NOT EXCEEDING 10 FEET.
- PER SECTION 1, GENERAL EXPLANATORY NOTE #22 OF THE GYPSUM ASSOCIATION - 600 - 2009 FIRE RESISTANCE DESIGN MANUAL (19TH EDITION) NOTE THE FOLLOWING: WHEN NOT SPECIFIED AS A COMPONENT OF A FIRE-RESISTANCE RATED WALL OR PARTITION SYSTEM, WOOD STRUCTURAL PANELS SHALL BE PERMITTED TO BE ADDED TO ONE OR BOTH SIDES. SUCH PANELS SHALL BE PERMITTED TO BE APPLIED EITHER AS A BASE LAYER DIRECTLY TO THE FRAMING (UNDER THE GYPSUM BOARD), AS A FACE LAYER (OVER THE FACE LAYER OF GYPSUM BOARD), OR BETWEEN LAYERS OF GYPSUM BOARD IN MULTI-LAYER SYSTEMS. WHEN SUCH PANELS ARE APPLIED UNDER THE GYPSUM BOARD OR BETWEEN LAYERS OF GYPSUM BOARD, THE LENGTH OF THE FASTENERS SPECIFIED FOR THE ATTACHMENT OF THE GYPSUM BOARD APPLIED OVER THE WOOD STRUCTURAL PANELS SHALL BE INCREASED BY NOT LESS THAT THE THICKNESS OF THE WOOD STRUCTURAL PANELS. FASTENER SPACING FOR THE GYPSUM BOARD AND THE NUMBER OF LAYERS OF GYPSUM BOARD SHALL BE AS SPECIFIED IN THE SYSTEM DESCRIPTION.
- PER SECTION 1, GENERAL EXPLANATORY NOTE #15 OF THE GYPSUM ASSOCIATION - 600 - 2009 FIRE RESISTANCE DESIGN MANUAL (19TH EDITION) NOTE THE FOLLOWING: GREATER STUD SIZES (DEPTHS) SHALL BE PERMITTED TO BE USED IN METAL- OR WOOD-STUD SYSTEMS. METAL STUDS OF HEAVIER GAGE THAN THOSE TESTED SHALL BE PERMITTED, THE ASSIGNED RATING OF ANY LOAD-BEARING SYSTEM SHALL ALSO APPLY TO THE SAME SYSTEM USED A NON-LOAD-BEARING SYSTEM. INDICATED STUD SPACINGS ARE MAXIMUMS.

SYNTHESIS 9, LLC
 5214 131st
 TACOMA, WA 98403

REGISTERED ARCHITECT
 BRITTA WALKER
 BRITTA WALKER ARCHITECTS
 STATE OF WASHINGTON

PRGA20250487

City of Puyallup
 Development & Permitting Services
 ISSUED PERMIT

Building Planning
 Engineering Public Works
 Fire Traffic

EAST TOWN CROSSING
BUILDING 'A'
 3002 E PIONEER WAY PUYALLUP WA 98372

AGENCY REVIEW - REVISION No.2 | 25.08.29

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

DRAWN BY: BL / CM
 CHECKED BY: BL
 DATE: 25.08.29
 TITLE: ASSEMBLY TYPES
 PROJECT #: 2016
 SHEET:
AG1.4

FLOOR/CEILING/ROOF ASSEMBLY REFERENCES

GA FILE NO. RC 2613	PROPRIETARY	1 HOUR FIRE
GYPSUM PANELS, RESILIENT CHANNELS, INSULATION, DAMPER, WOOD TRUSSES		
Fire Design: One layer 5/8" proprietary type X gypsum panels applied at right angles to resilient channels 16" o.c. with 1" Type S screws 18" o.c. Resilient channels 2" from panel edges on either side of end joints. Resilient channels applied at right angles to bottom chord of wood trusses 24" o.c. with 1 1/4" Type S screws. Minimum 3-1/2" of glass fiber insulation over the resilient channels or loose-fill cellulose insulation spray applied to the back of the ceiling membrane. Trusses supporting 15/32" wood structural panels applied at right angles to trusses with construction adhesive and 6d ring shank nails 12" o.c. Optional ceiling damper.		
PROPRIETARY GYPSUM PANEL United States Gypsum Company - 5/8" Sheetrock® Brand EcoSmart Panels Firecode® X		
Approx. Ceiling Weight: 1.8 psf (Fire) Fire Test: UL R1319, 47880382, 7-11-17, 478810382, 8-16-17, 4787448457, 10-3-16, UL Design T222, P531, P544		

GA FILE NO. RC 2601	GENERIC	1 HOUR FIRE
GYPSUM WALLBOARD, WOOD JOISTS, ROOF COVERING		
Fire Design: Base layer 5/8" type X gypsum wallboard applied at right angles to 2 x 10 wood joists 24" o.c. with 1 1/4" Type W or S screws 24" o.c. Face layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to joists with 1-7/8" Type W or S screws 12" o.c. at joints and intermediate joists and 1-1/2" Type G screws 12" o.c. placed 2" back on either side of end joints. Wood joists supporting 1/2" plywood with exterior glue applied at right angles to joists with 8d nails. Appropriate roof covering. Joints offset 24" from base layer joints.		
Approx. Ceiling Weight: 5 psf (Fire) Fire Test: FM FC 172, 2-25-72, ITS, 8-6-98		
WOOD JOISTS, GYPSUM WALLBOARD		
Fire Design: Base layer 5/8" type X gypsum wallboard applied at right angles to 2 x 10 wood joists 24" o.c. with 1 1/4" Type W or S screws 24" o.c. Face layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to joists with 1-7/8" Type W or S screws 12" o.c. at joints and intermediate joists and 1-1/2" Type G screws 12" o.c. placed 2" back on either side of end joints. Wood joists supporting 1/2" plywood with exterior glue applied at right angles to joists with 8d nails. Joints offset 24" from base layer joints.		
Approx. Ceiling Weight: 5 psf (Fire) Fire Test: FM FC 172, 2-25-72, ITS, 8-6-98		

GA FILE NO. FC 512	PROPRIETARY*	1 HOUR FIRE	50 to 54 STC SOUND
WOOD JOISTS, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, INSULATION, GYPSUM PANELS			
Fire Design: One layer 5/8" proprietary type X gypsum panel or gypsum veneer base applied at right angles to resilient channels 24" o.c. (16" o.c. when batt insulation is used, 12" o.c. when loose fill insulation is used) with 1" Type S screws 12" o.c. Gypsum panel and joists located midway between continuous channels and attached with screws 8" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to 2 x 10 wood joists spaced a maximum of 24" o.c. with 1 1/4" Type S screws. Glass or mineral fiber batt insulation stapled to exterior or loose fill insulation applied directly over gypsum panel. Wood joists supporting 15/32" wood structural panel subfloor applied at right angles to joists with construction adhesive and 6d ring shank nails 12" o.c. Minimum 1/2" proprietary gypsum floor topping applied over subfloor.			
Sound Design: STC and IIC rated with both joists and resilient channels spaced 16" o.c. 3-1/2" glass fiber insulation in joist spaces. 1" proprietary gypsum floor topping poured over 1/4" proprietary sound reduction mat and with finish flooring of CAP, sheet vinyl, engineered wood laminate, and ceramic tile.			
PROPRIETARY GYPSUM COMPONENTS United States Gypsum Company, 5/8" Sheetrock® Brand Firecode® C Gypsum Panels Levocab® Brand Floor Underlayment			

GA FILE NO. FC 529	GENERIC	1 HOUR FIRE
WOOD JOISTS, GYPSUM WALLBOARD		
Fire Design: Base layer 5/8" type X gypsum wallboard applied at right angles to 2 x 10 wood joists 24" o.c. with 1 1/4" Type W or S screws 24" o.c. Face layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to joists with 1-7/8" Type W or S screws 12" o.c. at joints and intermediate joists and 1-1/2" Type G screws 12" o.c. placed 2" back on either side of end joints. Wood joists supporting 1/2" plywood with exterior glue applied at right angles to joists with 8d nails. Joints offset 24" from base layer joints.		
Approx. Ceiling Weight: 5 psf (Fire) Fire Test: FM FC 172, 2-25-72, ITS, 8-6-98		

WALLS ASSEMBLY REFERENCES

GA FILE NO. WP 5512	GENERIC	1 HOUR FIRE	50 to 54 STC SOUND
CHASE WALLS, WOOD FRAMED			
GYPSUM WALLBOARD, WOOD STUDS, INSULATION			
Fire Design: One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of double row of 2 x 4 wood studs 16" o.c. on separate plates 1" apart with 2" Type W screws 7" o.c. Two layers 3-1/2" unfaced glass fiber insulation friction fit in stud cavity. Joints staggered 16" on opposite sides. Horizontal bracing required at mid-height. (LOAD-BEARING)			
Sound Design: Sound tested as constructed for fire.			
Thickness: Minimum 9-1/4" (Fire and Sound) Approx. Weight: 7.1 psf (Fire and Sound) Fire Test: UL Design U341, UL R4024, 10-31-68 Sound Test: NCAL 17-0837, 8-25-17			

GA FILE NO. WP 3242	GENERIC	1 HOUR FIRE	50 to 54 STC SOUND
WALLS AND INTERIOR PARTITIONS, WOOD FRAMED			
GYPSUM WALLBOARD, RESILIENT CHANNELS, INSULATION, WOOD STUDS			
Fire Design: Resilient channels 16" o.c. attached at right angles to ONE SIDE of 2 x 4 wood studs 24" o.c. with 1-1/4" Type S screws. One layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1" Type S screws 8" o.c. with vertical joints located midway between studs. 3" mineral or glass fiber insulation in stud cavity.			
OPPOSITE SIDE: One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 6d cement coated nails, 1-7/8" long, 0.0915" shank, 15/64" heads, 7" o.c. Joints of square edge, level edge or predecorated wallboard may be left exposed. (LOAD-BEARING)			
Sound Design: Sound tested as constructed for fire.			
Thickness: 5-3/8" (Fire and Sound) Approx. Weight: 7 psf (Fire and Sound) Fire Test: Based on UL R14196, 05N050371, 2-15-05, UL Design U309 Sound Test: NRCC TL-93-098, IRC-IF-761, 3-98			

GA FILE NO. WP 8105	GENERIC	1 HOUR FIRE
GYPSUM WALLBOARD, GYPSUM SHEATHING, WOOD STUDS		
Fire Design: EXTERIOR SIDE: One layer 48" wide 5/8" type X gypsum sheathing applied parallel to 2 x 4 wood studs 24" o.c. with 1-3/4" galvanized roofing nails 4" o.c. at vertical joints and 7" o.c. at intermediate studs and top and bottom plates. Joints of gypsum sheathing may be left unsealed. Exterior cladding to be attached through sheathing to studs.		
INTERIOR SIDE: One layer 5/8" type X gypsum wallboard, water-resistant gypsum backing board, or gypsum veneer base applied parallel or at right angles to studs with 6d coated nails, 1-7/8" long, 0.0915" shank, 1/4" heads, 7" o.c. (LOAD-BEARING)		
Thickness: Varies (Fire) Approx. Weight: 7 psf (Fire) Fire Test: See WP 3510, UL R3501-47, -48, 9-17-65, Design 099, UL R1319-129, 7-22-70, UL Design U314		

GA FILE NO. WP 3605	GENERIC	1 HOUR FIRE
GYPSUM WALLBOARD, WOOD STUDS		
Fire Design: One layer 5/8" type X plain or predecorated gypsum wallboard, water-resistant gypsum backing board, or gypsum veneer base applied parallel or at right angles to each side of 2 x 4 wood studs 16" o.c. with 6d coated nails, 1-7/8" long, 0.0915" shank, 1/4" heads, 7" o.c. Joints of square edge, level edge or predecorated wallboard may be left exposed. (LOAD-BEARING)		
Sound Design: Joints staggered 16" on opposite sides. (LOAD-BEARING)		
Thickness: 4-7/8" (Fire) Approx. Weight: 7 psf (Fire) Fire Test: UL R1319-4, 6, 6-17-52, UL R1319-39, 1-20-66, UL R3501-62, 3-15-66, UL Design U305, ULC Design W301		

PRIVATE DECK FLOOR/CEILING ASSEMBLY

ICC EVALUATION SERVICE

ICC-ES Evaluation Report

ESR-2201
Reissued July 2020
Revised December 2020
This report is subject to renewal July 2022.

www.icc-es.org | (800) 423-6587 | (562) 699-0543 A Subsidiary of the International Code Council®

DIVISION: 07 00 00—THERMAL AND MOISTURE PROTECTION	Section: 07 18 13—Pedestrian Traffic Coatings
REPORT HOLDER: WESTCOAT	Custom Systems consist of the material described in Section 4.3.
EVALUATION SUBJECT: WESTCOAT ALX STANDARD, ALX CUSTOM, ALX PRO STANDARD, AND ALX PRO CUSTOM SYSTEMS	3.2 Materials: 3.2.1 Plywood Substrate: Plywood substrates must be exterior grade, 5/8-inch-thick (15.9 mm) plywood complying with U.S. DOC PS-1 or PS-2. 3.2.2 Metal Lath: The metal lath must be 2.5 lb/yd ² (1.36 kg/m ²), hot-dipped galvanized, expanded metal lath, complying with ASTM C847. The Westcoat part number is WP-25 Metal Lath. 3.2.3 Staples: Staples must be corrosion-resistant, minimum No. 16 gauge staples with 1-inch-wide (25 mm) crowns and 7/8-inch-long (15.9 mm) legs, complying with ASTM F1687. The Westcoat part number is WP-10 Staples. 3.2.4 WP-40 Sheet Membrane: The WP-40 Membrane is a self-adhering, nominally 4 mil [0.04 inch (1.02 mm)] membrane recognized in Section 4.4 of this report. 3.2.5 WP-47H Fiberglass (For use with Westcoat ALX Pro Custom Systems) is a glass fiber lath reinforcement and 6 per inch weight (0.019-inch thick, 5.8 ounces per roll) material.
1.0 EVALUATION SCOPE Compliance with the following codes: ■ 2021, 2018, 2015, 2012, 2009 and 2006 International Building Code® (IBC) ■ 2021, 2018, 2015, 2012, 2009 and 2006 International Residential Code® (IRC) ■ 2013 Abu Dhabi International Building Code (ADIBC) The ADIBC is based on the 2009 IBC. 2009 IBC code sections referenced in this report are the same sections in the ADIBC. For evaluation for compliance with codes adopted by the Los Angeles Department of Building and Safety (LADBS), see ESR-2201 LABC and LARC Supplement.	Properties evaluated: ■ Durability ■ Wind resistance ■ Fire classification ■ Fire resistance
2.0 USES Westcoat ALX Standard, ALX Custom, ALX Pro Standard and ALX Pro Custom Systems are cementitious coating systems for use as walking deck and classified roof covering systems over plywood substrates. The systems, as described in Section 4.4 of this report, provide a Class A roof covering fire classification. The systems, as described in Section 4.5 of this report, are used as a component of a one-hour fire-resistance-rated assembly.	3.2.6 WP-9 Pro Standard WP-90 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place. 3.2.7 WP-9 Pro Standard WP-90 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place. 3.2.8 TC-1 Basecoat Cement is a proprietary portland cement and silica in 50-pound (22.5 kg) bags, stored in dry conditions. 3.2.9 TC-2 Smooth Texture Cement is a proprietary portland cement and silica in 50-pound (22.5 kg) bags, stored in dry conditions.
3.0 DESCRIPTION 3.1 General: The ALX Standard, ALX Custom, ALX Pro Standard, and ALX Pro Custom Systems are walking deck and roof covering systems applied over plywood. The ALX Standard and ALX Pro Standard Systems consist of the materials described in Section 4.2 and the ALX Custom and ALX Pro	3.2.10 TC-3 Medium Texture Cement: The TC-3 Medium Texture Cement is a proprietary dry-blend mixture including portland cement and silica sand. The product is packaged in 50-pound (22.5 kg) bags. Shelf life is one year when stored in dry conditions. 3.2.11 TC-5 Grout Texture Cement: The TC-5 Grout Texture Cement is a proprietary dry-blend mixture including portland cement and silica sand. The product is packaged in 50-pound (22.5 kg) bags. Shelf life is one year when stored in dry conditions. 3.2.12 SC-10 Acrylic Topcoat: The SC-10 Acrylic Topcoat is a proprietary, water-based liquid sealant used as the topcoat of the Westcoat ALX system. This product is packaged in 1- or 5-gallon pails (3.78 or 18.9 L). Shelf life is two years when stored at temperatures between 40° and 100°F (4.4°C and 37.8°C) and in a dry place. 3.2.13 SC-35 Water-Based Stain: The Water-Based Stain is a proprietary blend of pigments, used to stain TC-3 Medium Texture Cement. The product is packaged in 1- or 5-gallon pails (3.78 or 18.9 L). Shelf life is two years when stored in dry conditions. 3.2.14 TC-1 Pro Standard WP-10 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place. 3.2.15 TC-2 Pro Standard WP-20 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place. 3.2.16 TC-3 Pro Standard WP-30 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place. 3.2.17 TC-4 Pro Standard WP-40 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place. 3.2.18 TC-5 Pro Standard WP-50 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place. 3.2.19 TC-6 Pro Standard WP-60 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place. 3.2.20 TC-7 Pro Standard WP-70 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place. 3.2.21 TC-8 Pro Standard WP-80 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place. 3.2.22 TC-9 Pro Standard WP-90 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place. 3.2.23 TC-10 Pro Standard WP-100 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place.

ESR-2201 | Most Widely Accepted and Trusted

Page 2 of 5

packaged in 50-pound (22.5 kg) bags. Shelf life is one year when stored in dry conditions.

3.2.10 TC-3 Medium Texture Cement: The TC-3 Medium Texture Cement is a proprietary dry-blend mixture including portland cement and silica sand. The product is packaged in 50-pound (22.5 kg) bags. Shelf life is one year when stored in dry conditions.

3.2.11 TC-5 Grout Texture Cement: The TC-5 Grout Texture Cement is a proprietary dry-blend mixture including portland cement and silica sand. The product is packaged in 50-pound (22.5 kg) bags. Shelf life is one year when stored in dry conditions.

3.2.12 SC-10 Acrylic Topcoat: The SC-10 Acrylic Topcoat is a proprietary, water-based liquid sealant used as the topcoat of the Westcoat ALX system. This product is packaged in 1- or 5-gallon pails (3.78 or 18.9 L). Shelf life is two years when stored at temperatures between 40° and 100°F (4.4°C and 37.8°C) and in a dry place.

3.2.13 SC-35 Water-Based Stain: The Water-Based Stain is a proprietary blend of pigments, used to stain TC-3 Medium Texture Cement. The product is packaged in 1- or 5-gallon pails (3.78 or 18.9 L). Shelf life is two years when stored in dry conditions.

3.2.14 TC-1 Pro Standard WP-10 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place.

3.2.15 TC-2 Pro Standard WP-20 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place.

3.2.16 TC-3 Pro Standard WP-30 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place.

3.2.17 TC-4 Pro Standard WP-40 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place.

3.2.18 TC-5 Pro Standard WP-50 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place.

3.2.19 TC-6 Pro Standard WP-60 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place.

3.2.20 TC-7 Pro Standard WP-70 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place.

3.2.21 TC-8 Pro Standard WP-80 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place.

3.2.22 TC-9 Pro Standard WP-90 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place.

3.2.23 TC-10 Pro Standard WP-100 Waterproofer are formulated with Basecoat Cement, Medium Cement, and in a dry place.

ESR-2201 | Most Widely Accepted and Trusted

Page 3 of 5

4.1.3 Metal Lath: The metal lath, as described in Section 3.2.2, must be installed with lath edges parallel to plywood substrate joints and offset from the substrate joints by a minimum of 2 inches (51 mm). The lath must be held back 1/2 inch (12.7 mm) from all deck edges and stapled to plywood substrate with no less than 16 staples per square foot (174 staples per square meter). Lath must be applied to plywood substrate every 1 to 2 inches.

4.1.4 Base Coat: The base coat must be applied to the metal lath with a trowel and until uniform.

4.3 ALX Custom and ALX Pro Custom Systems (Following installation in accordance with Section 4.1):

4.3.1 Grout Coat: The grout coat mixture consists of one 50-pound (22.5 kg) bag of TC-5 Grout Texture Cement combined with 1 gallon (3.78 L) of WP-81, and up to 1 gallon (1.89 L) of water, then mixed until uniform consistency is achieved. The mixture results in a 4.5-gallon (17.0 L) batch. The grout coat mixture must be applied to the metal lath at a rate of 150 to 200 square feet (13.7 to 18.6 m²) per 4.5-gallon (17.0 L) batch. The dry thickness of the grout coat must be 1/2 inch (12.7 mm). Prior to application of the texture coat must be smoothed with a trowel and until firm.

4.4 Class A Roof Covering over Plywood Deck: When the Westcoat ALX Standard, ALX Custom, ALX Pro Standard, and ALX Pro Custom Systems are applied over a minimum 5/8-inch-thick (15.9 mm) plywood substrate with all edges blocked and installed in accordance with Section 4.0 at a maximum roof slope of 1/4 inch per 1 foot (2% slope), the system provides a Class A roof classification.

4.5 One-hour Fire-resistance-rated Construction:

4.5.1 ALX Standard and ALX Custom Systems: When the Westcoat ALX Standard and ALX Custom systems are installed in accordance to Section 4.0, over 5/8-inch-thick (15.9 mm) exterior-grade plywood complying with PS-1, with nominally 2-by-10 wood joists spaced at a maximum of 16 inches (406 mm) on center, and all plywood joints blocked, the assembly can be recognized as an alternative for the double wood floor described in Item 13 of Table 721.1(3) of the 2015 IBC and 2012 IBC [Table 720.1(3) of the 2009 and 2006 IBC]. The design bending stress must be limited to 75 percent of the code prescribed design values for the wood joist.

4.5.2 ALX Pro Standard and ALX Pro Custom Systems: When the Westcoat ALX Pro Standard and ALX Pro Custom Systems are installed in accordance to Section 4.0 over 5/8-inch-thick (15.9 mm) exterior-grade plywood complying with PS-1, with nominally 2-by-10 wood joists spaced at a maximum of 16 inches (406 mm) on center, and all plywood joints blocked, the assembly can be recognized as an alternative for the double wood floor described in Item 13-1.4 of Table 721.1(3) of the 2016 IBC and 2012 IBC [Table 720.1(3) of the 2009 and 2006 IBC].

except that the 5/8-inch-thick Type X gypsum wallboard must be replaced with 5/8-inch-thick Type X gypsum wallboard. The design bending stress must be limited to 75 percent of the code prescribed design values for the wood joist.

4.6 Wind Resistance:
Installation must be limited to buildings with a maximum height of 40 feet (12.2 m) above grade, in Exposure B areas, with either a basic wind speed of 130 mph (209 km/h) under the 2021 IBC and 2018 IBC, an ultimate design wind speed of 130 mph (209 km/h) under the 2021 IRC, 2018 IRC, 2015 IBC, 2015 IRC, and 2012 IBC or a maximum 3-second-gust basic wind speed of 100 miles per hour (161 km/h) under the 2009 and 2006 IBC and the 2012, 2009 and 2006 IRC. The plywood and its attachment to support framing must be adequate to resist the required wind load.

4.7 Method of Repair:
The damaged area must be completely removed, including the base coat and lath. New metal lath must be stapled to the clean, dry substrate, and the system reapplied as described in Sections 4.1 through 4.6 of this report. If substrate damage occurs, the retention of the strength properties of the system must be investigated.

5.0 CONDITIONS OF USE
The Westcoat ALX Standard, ALX Custom, ALX Pro Standard and ALX Pro Custom Systems described in this report comply with, or are suitable alternatives to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

5.1 Materials must be manufactured and applied in accordance with this report, the applicable code, and the manufacturer's published installation instructions. In the event of conflict between this report and the manufacturer's installation instructions, this report governs.

5.2 The WP-81 Cement Modifier, WP-90 Cement Modifier, WP-47H Fiberglass, TC-1 Basecoat Cement, TC-2 Smooth Texture Cement, TC-3 Medium Texture Cement, TC-5 Grout Texture Cement, SC-10 Acrylic Topcoat, SC-35 Water-Based Stain, TC-40 Liquid Colorant and SC-70 Acrylic Lacquer Sealer products are produced under a quality control program with inspections by ICC-ES.

6.0 EVIDENCE SUBMITTED
Data in accordance with the ICC-ES Acceptance Criteria for Walking Decks (AC39), dated June 2017 (Editorially revised November 2020).

7.0 IDENTIFICATION
7.1 The WP-81 Cement Modifier, WP-90 Cement Modifier, WP-47H Fiberglass, TC-1 Basecoat Cement, TC-2 Smooth Texture Cement, TC-3 Medium Texture Cement, TC-5 Grout Texture Cement, SC-10 Acrylic Topcoat, SC-35 Water-Based Stain, TC-40 Liquid Colorant and SC-70 Acrylic Lacquer Sealer products must be labeled with the Westcoat name and address, the date of manufacture, the shelf life, and the lot number or production number. In addition to the above, the products are labeled with the ICC-ES report number (ESR-2201).

7.2 The report holder's contact information is the following:
WESTCOAT
4007 LOCKRIDGE STREET
SAN DIEGO, CALIFORNIA 92102
(600) 250-4519
www.westcoat.com



S9

SYNTHESIS 9, LLC
5214 N ST
TACOMA, WA 98403

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE EXHIBITS HERETO
INCORPORATED HEREIN ARE THE PROPERTY OF
SYNTHESIS 9, LLC AND ARE NOT TO BE USED OR
REPRODUCED IN WHOLE OR IN PART WITHOUT THE
WRITTEN AUTHORIZATION OF SYNTHESIS 9, LLC.

REGISTERED ARCHITECT
ANNETTE WALKER
SHEILA HALLER LINDSAY
STATE OF WASHINGTON

PRGA20250487

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building Planning
Engineering Public Works
Fire Traffic

EAST TOWN CROSSING
BUILDING 'A'
3002 E PIONEER WAY PUYALLUP WA 98372


AGENCY REVIEW - REVISION No.2 | 25.08.29

REVISIONS
01 RESPONSE TO 1st REVIEW, 2025.08.08
02 RESPONSE TO 2nd REVIEW, 2025.07.31


DRAWN BY: BL / CM
CHECKED BY: BL
DATE: 25.08.29
TITLE: ASSEMBLY REFERENCES
PROJECT #: 2016
SHEET:

AG1.5


ACCESSIBLE DOOR CLEARANCE

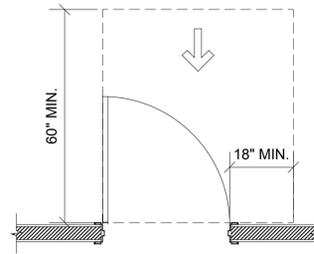


FRONT APPROACH, PULL SIDE

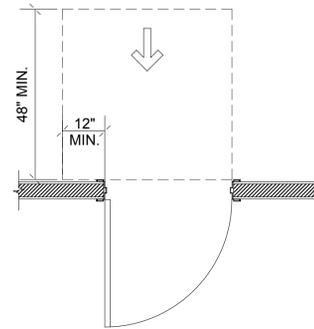


FRONT APPROACH, PUSH SIDE

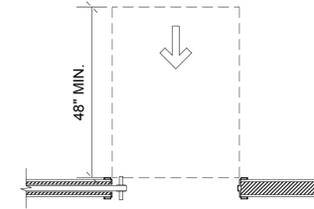


FRONT APPROACH, POCKET

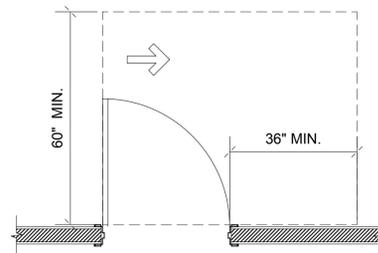


HINGE APPROACH, PULL SIDE

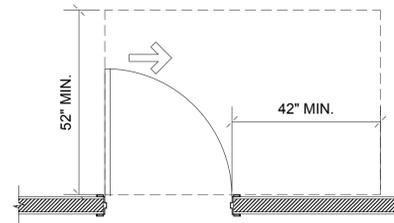

HINGE APPROACH, PUSH SIDE

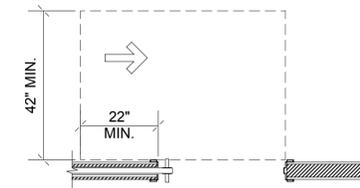


POCKET OR HINGE APPROACH

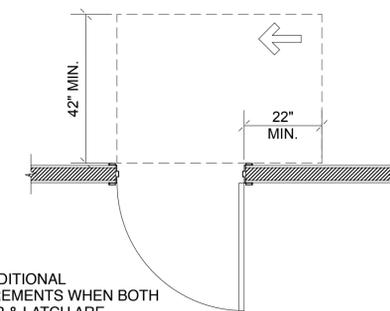


HINGE APPROACH, PUSH SIDE

SEE ADDITIONAL REQUIREMENTS WHEN BOTH CLOSER & LATCH ARE PROVIDED PER FIGURE 404.2.3.2 (ON THIS SHEET)

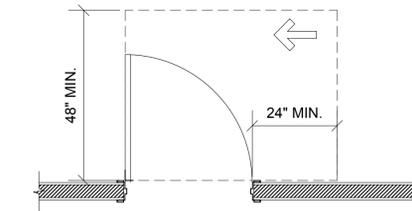


LATCH APPROACH, PULL SIDE

SEE ADDITIONAL REQUIREMENTS WHEN BOTH CLOSER & LATCH ARE PROVIDED PER FIGURE 404.2.3.2 (ON THIS SHEET)

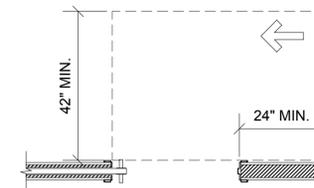


STOP OR LATCH APPROACH

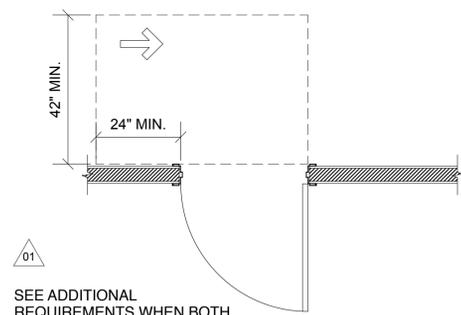

LATCH APPROACH, PUSH SIDE


SEE ADDITIONAL REQUIREMENTS WHEN BOTH CLOSER & LATCH ARE PROVIDED PER FIGURE 404.2.3.2 (ON THIS SHEET)

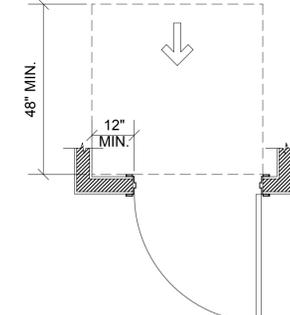


PUSH SIDE, W/ CLOSER & LATCH

402.2.2 CLEAR WIDTH
DOORWAYS SHALL HAVE A CLEAR OPENING WIDTH OF 32 INCHES MINIMUM. CLEAR OPENING WIDTH OF DOORWAYS WITH SWINGING DOORS SHALL BE MEASURED BETWEEN THE FACE OF THE DOOR AND STOP, WITH THE DOOR OPEN 90 DEGREES. OPENINGS MORE THAN 24 INCHES IN DEPTH AT DOORS AND DOORWAYS WITHOUT DOORS SHALL PROVIDE A CLEAR OPENING WIDTH OF 36 INCHES MINIMUM. THERE SHALL BE NO PROJECTIONS INTO THE CLEAR OPENING WIDTH LOWER THAN 34 INCHES ABOVE THE FLOOR. PROJECTIONS INTO THE CLEAR OPENING WIDTH BETWEEN 34 INCHES AND 80 INCHES ABOVE THE FLOOR SHALL NOT EXCEED 4 INCHES.

- EXCEPTIONS:
1. DOOR CLOSERS AND DOOR STOPS SHALL BE PERMITTED TO BE 78 INCHES MINIMUM ABOVE THE FLOOR.
 2. IN ALTERATIONS, A PROJECTION OF 5/8" MAXIMUM INTO THE REQUIRED CLEAR OPENING WIDTH SHALL BE PERMITTED FROM THE LATCH SIDE STOP.

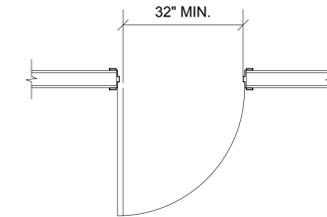

(A) HINGE DOOR



(B) SLIDING DOOR

CLEAR WIDTH OF OPENINGS

TABLE 404.2.3.2— MANEUVERING CLEARANCES AT MANUAL SWINGING DOORS

Approach Direction	Door Side	MANEUVERING CLEARANCES AT MANUAL SWINGING DOORS	
		Perpendicular to Doorway	Parallel to Doorway (beyond latch unless noted)
From front	Pull	60 inches (1525 mm)	18 inches (455 mm)
From front	Push	48 inches (1220 mm)	0 inches (0 mm) ³
From hinge side	Pull	60 inches (1525 mm)	36 inches (915 mm)
From hinge side	Push	54 inches (1370 mm)	42 inches (1065 mm)
From latch side	Pull	42 inches (1065 mm) ¹	22 inches (560 mm) ^{3 & 4}
From latch side	Push	48 inches (1220 mm) ²	24 inches (610 mm)
From latch side	Push	42 inches (1065 mm) ²	24 inches (610 mm)

¹Add 6 inches (150 mm) if closer and latch provided.
²Add 6 inches (150 mm) if closer provided.
³Add 12 inches (305 mm) beyond latch if closer and latch provided.
⁴Beyond hinge side.



SYNTHESIS 9, LLC
5214 S ST
TACOMA, WA 98403

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE ORIGINAL DESIGN
INCORPORATED HEREIN AS PERMITSMENTS OF
PROFESSIONAL SERVICE ARE THE PROPERTY OF
SYNTHESIS 9, LLC AND ARE NOT TO BE USED OR
REPRODUCED IN WHOLE OR IN PART WITHOUT THE
WRITTEN AUTHORIZATION OF SYNTHESIS 9, LLC.



PRGA20250487



EAST TOWN CROSSING
BUILDING 'A'
3002 E PIONEER WAY PUYALLUP WA 98372


REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

AGENCY REVIEW - REVISION No.2 | 25.08.29


REVISIONS

DRAWN BY: BL / CM
CHECKED BY: BL
DATE: 25.08.29
TITLE: ACCESSIBLE ENTRANCES
PROJECT #: 2016
SHEET:


AG1.6

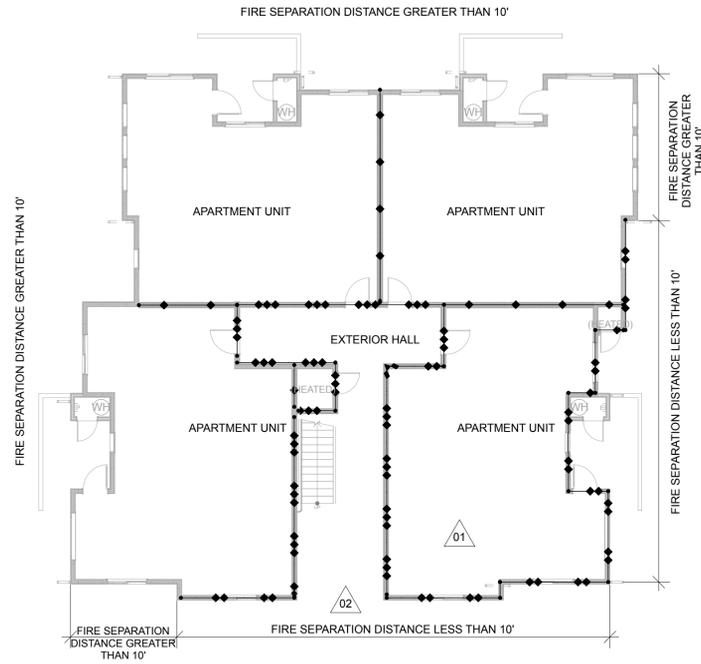

2 RATED WALLS LEVEL 1
SCALE: 3/32" = 1'-0"

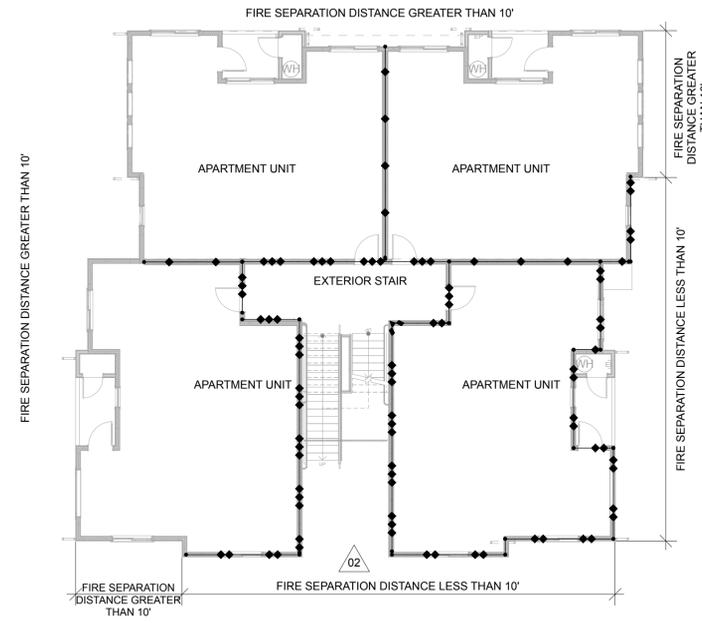


1 RATED WALLS LEVEL 2
SCALE: 3/32" = 1'-0"

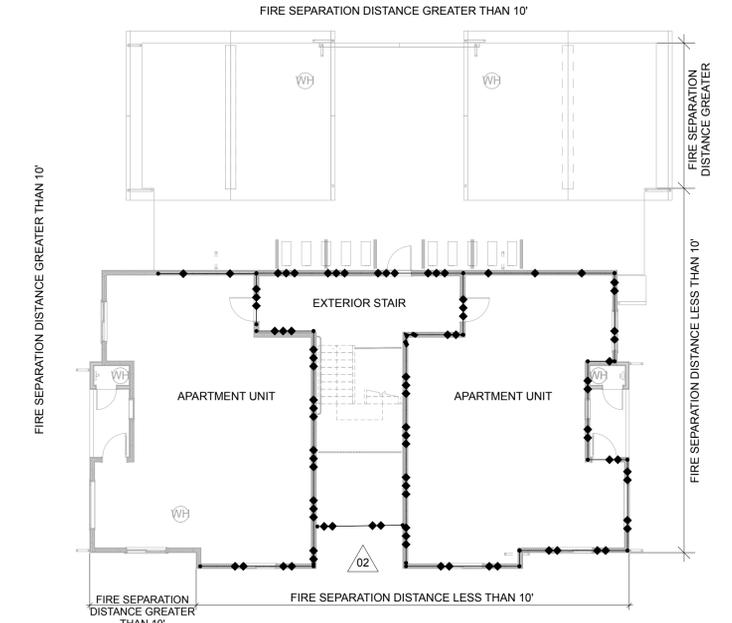


6 RATED WALLS LEVEL 3
SCALE: 3/32" = 1'-0"

RATED ASSEMBLY DIAGRAM LEGEND

- ◆◆◆◆ 1-HR RATED PARTITION WALL ASSEMBLY AND/OR 1-HR RATED FLOOR/CEILING ASSEMBLY OR 1-HR CEILING/ROOF ASSEMBLY
- ◆◆◆◆ EXTERIOR WALL
1-HR RATED WALL ASSEMBLY WITH OPENINGS LIMITED TO 10% WHEN DISTANCE TO PROPERTY LINE IS BETWEEN 5-FT TO 10-FT, NO OPENINGS WHEN DISTANCE LESS THAN 5-FT, WALL SHALL BE RATED FOR EXPOSURE TO FIRE FROM BOTH SIDES
- ◆◆◆◆ EXIT PASSAGEWAY
1-HR RATED, FIRE BARRIER, CONTINUOUS TO FLOOR DECKS WITH 1-HR RATED OPENINGS & 1-HR RATED CEILING/ROOF ASSEMBLY

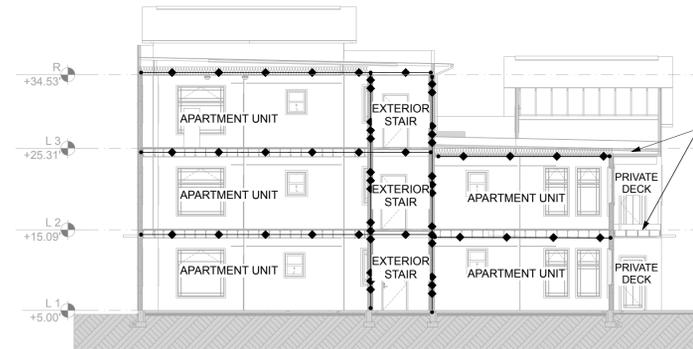

5 RATED ASSEMBLIES SECTION 2
SCALE: 3/32" = 1'-0"

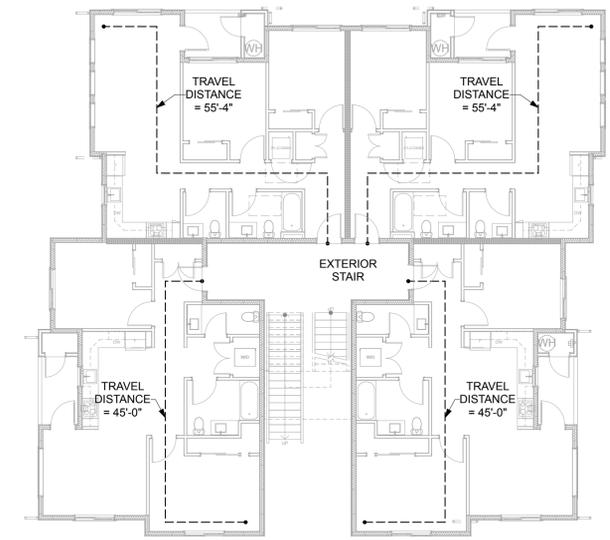

NOTE: MAXIMUM TRAVEL DISTANCE TO THE EXTERIOR STAIR SHALL NOT EXCEED 125-FT

4 TYPICAL EXIT DIAGRAM - TRAVEL DISTANCE
SCALE: 3/32" = 1'-0"
*DIAGRAM REPRESENTS FURTHEST TRAVEL

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31


REVISIONS

DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	CODE DIAGRAMS
PROJECT #:	2016
SHEET:	

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

REVISIONS	

DRAWN BY: BL / CM
 CHECKED BY: BL
 DATE: 25.08.29
 TITLE: LEVEL 1 FLOOR PLAN
 PROJECT #: 2016
 SHEET:

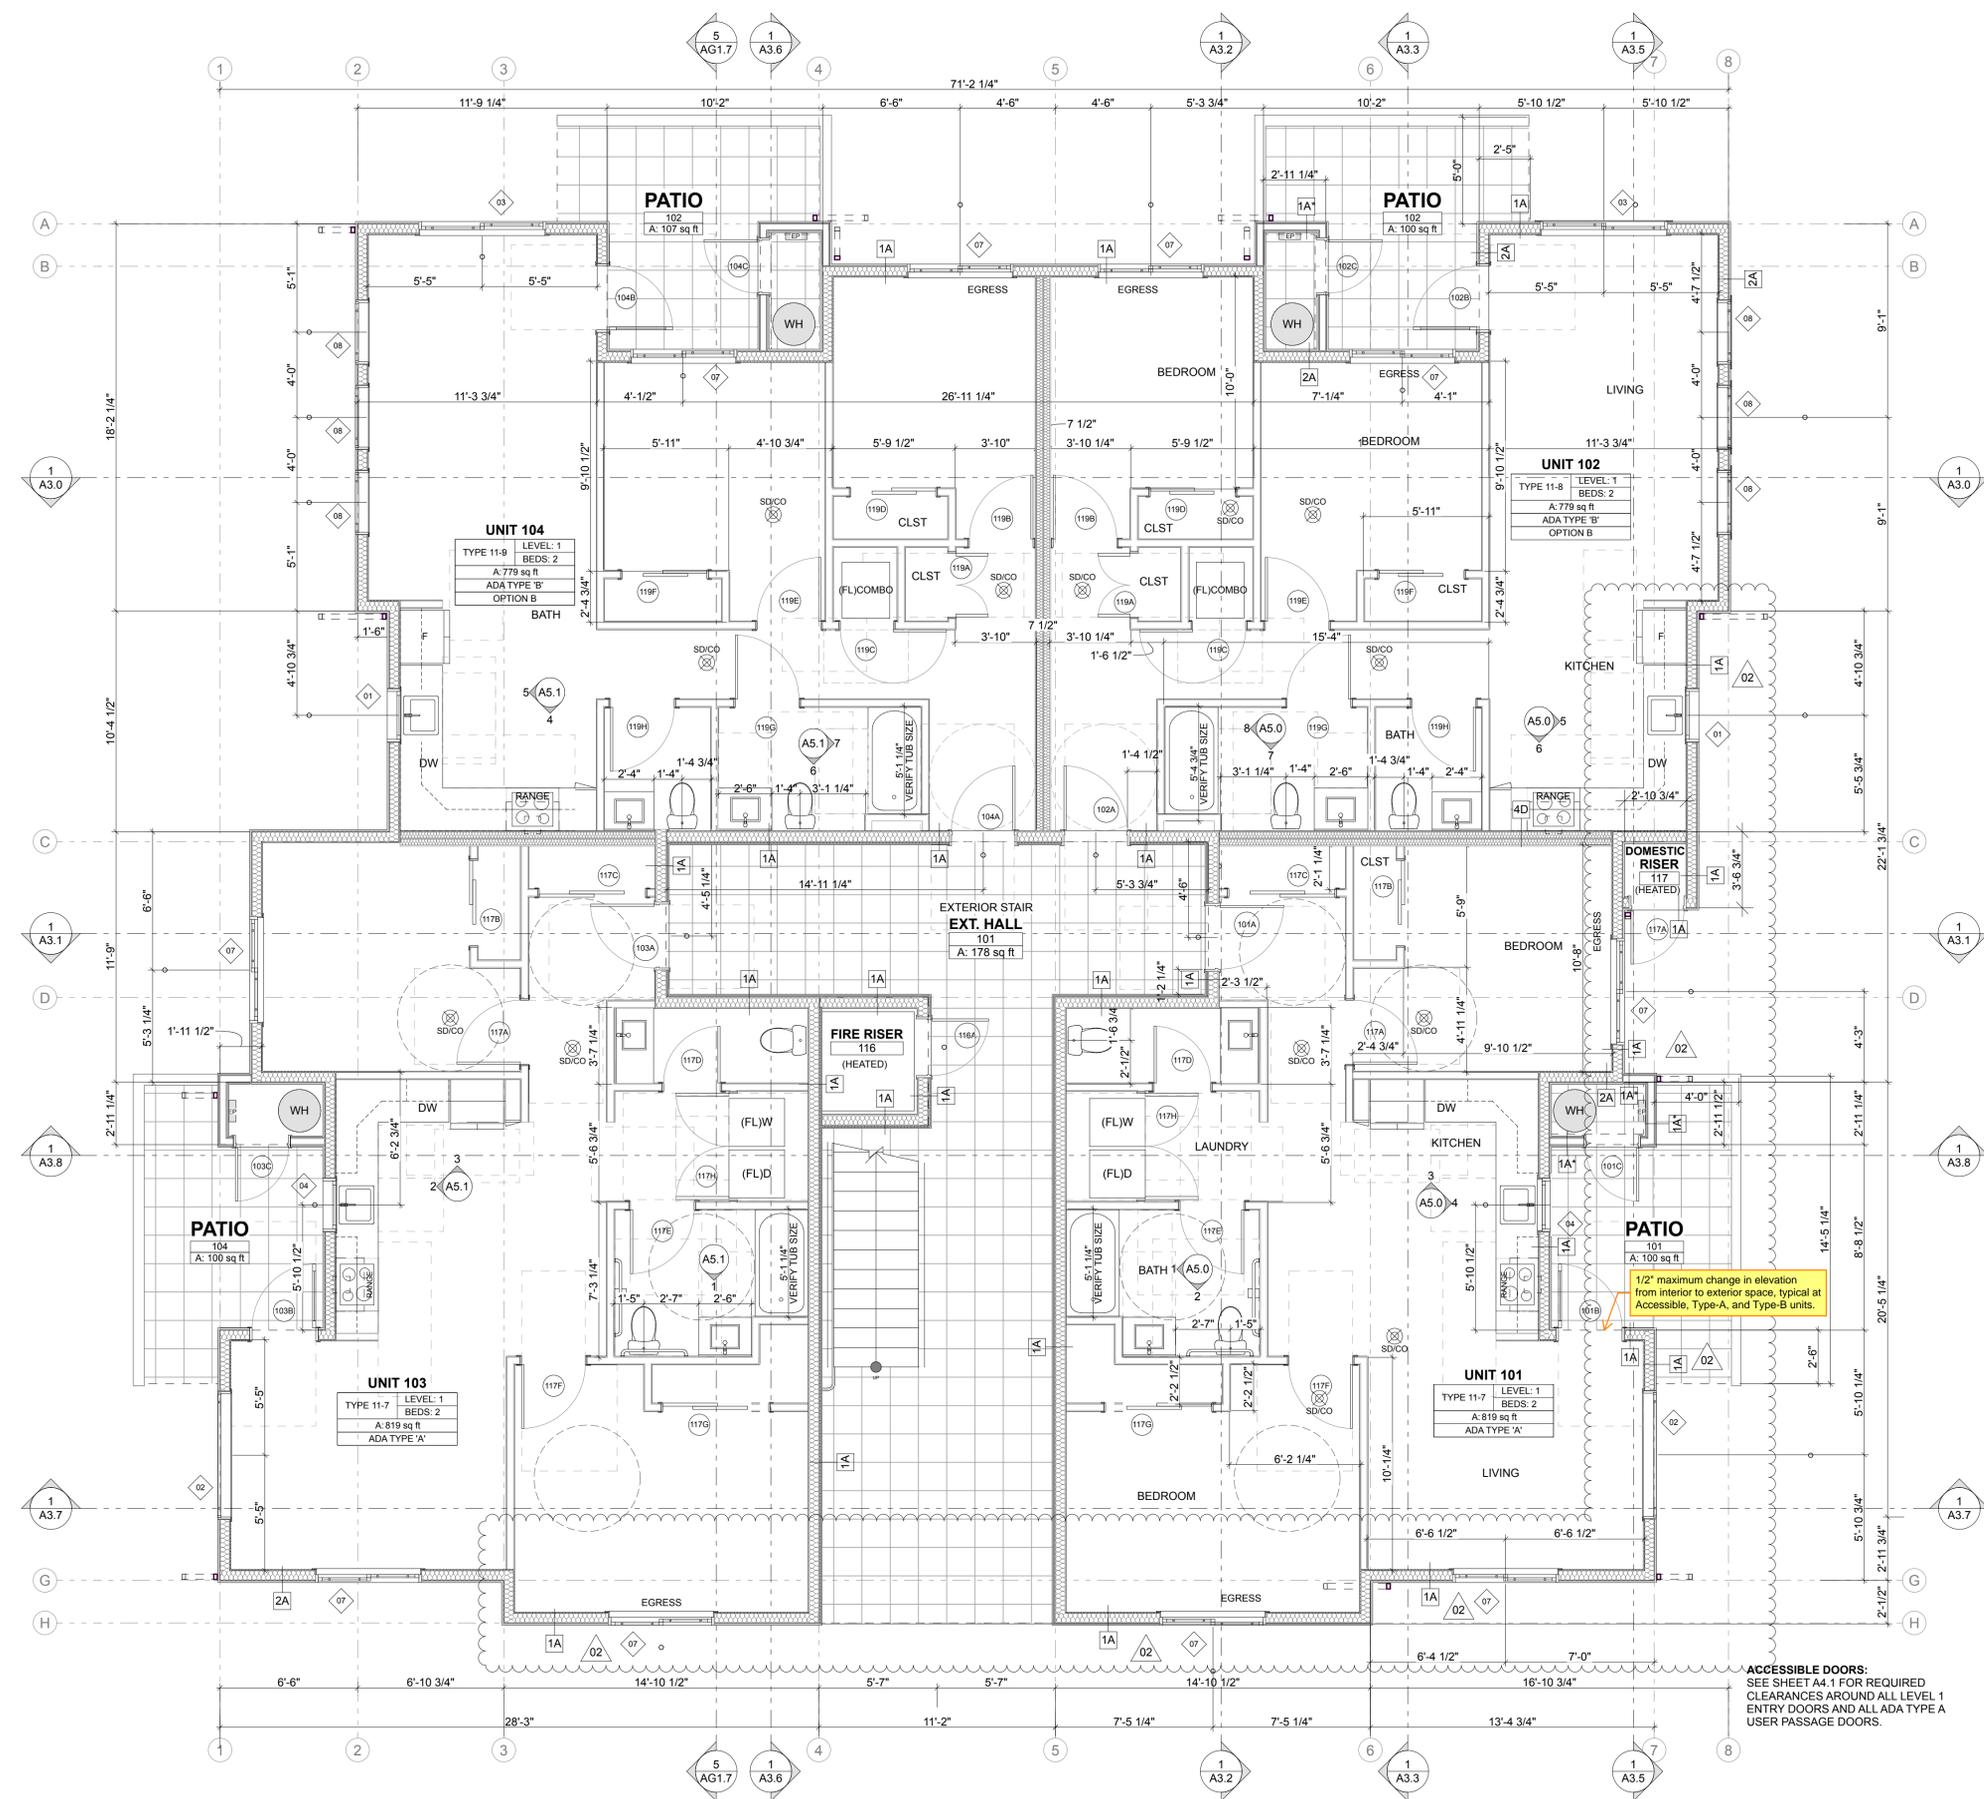


1 LEVEL 1 FLOOR PLAN
SCALE: 1/4" = 1'-0"



REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

REVISIONS	

DRAWN BY: BL / CM
CHECKED BY: BL
DATE: 25.08.29
TITLE: LEVEL 2 FLOOR PLAN
PROJECT #: 2016
SHEET:

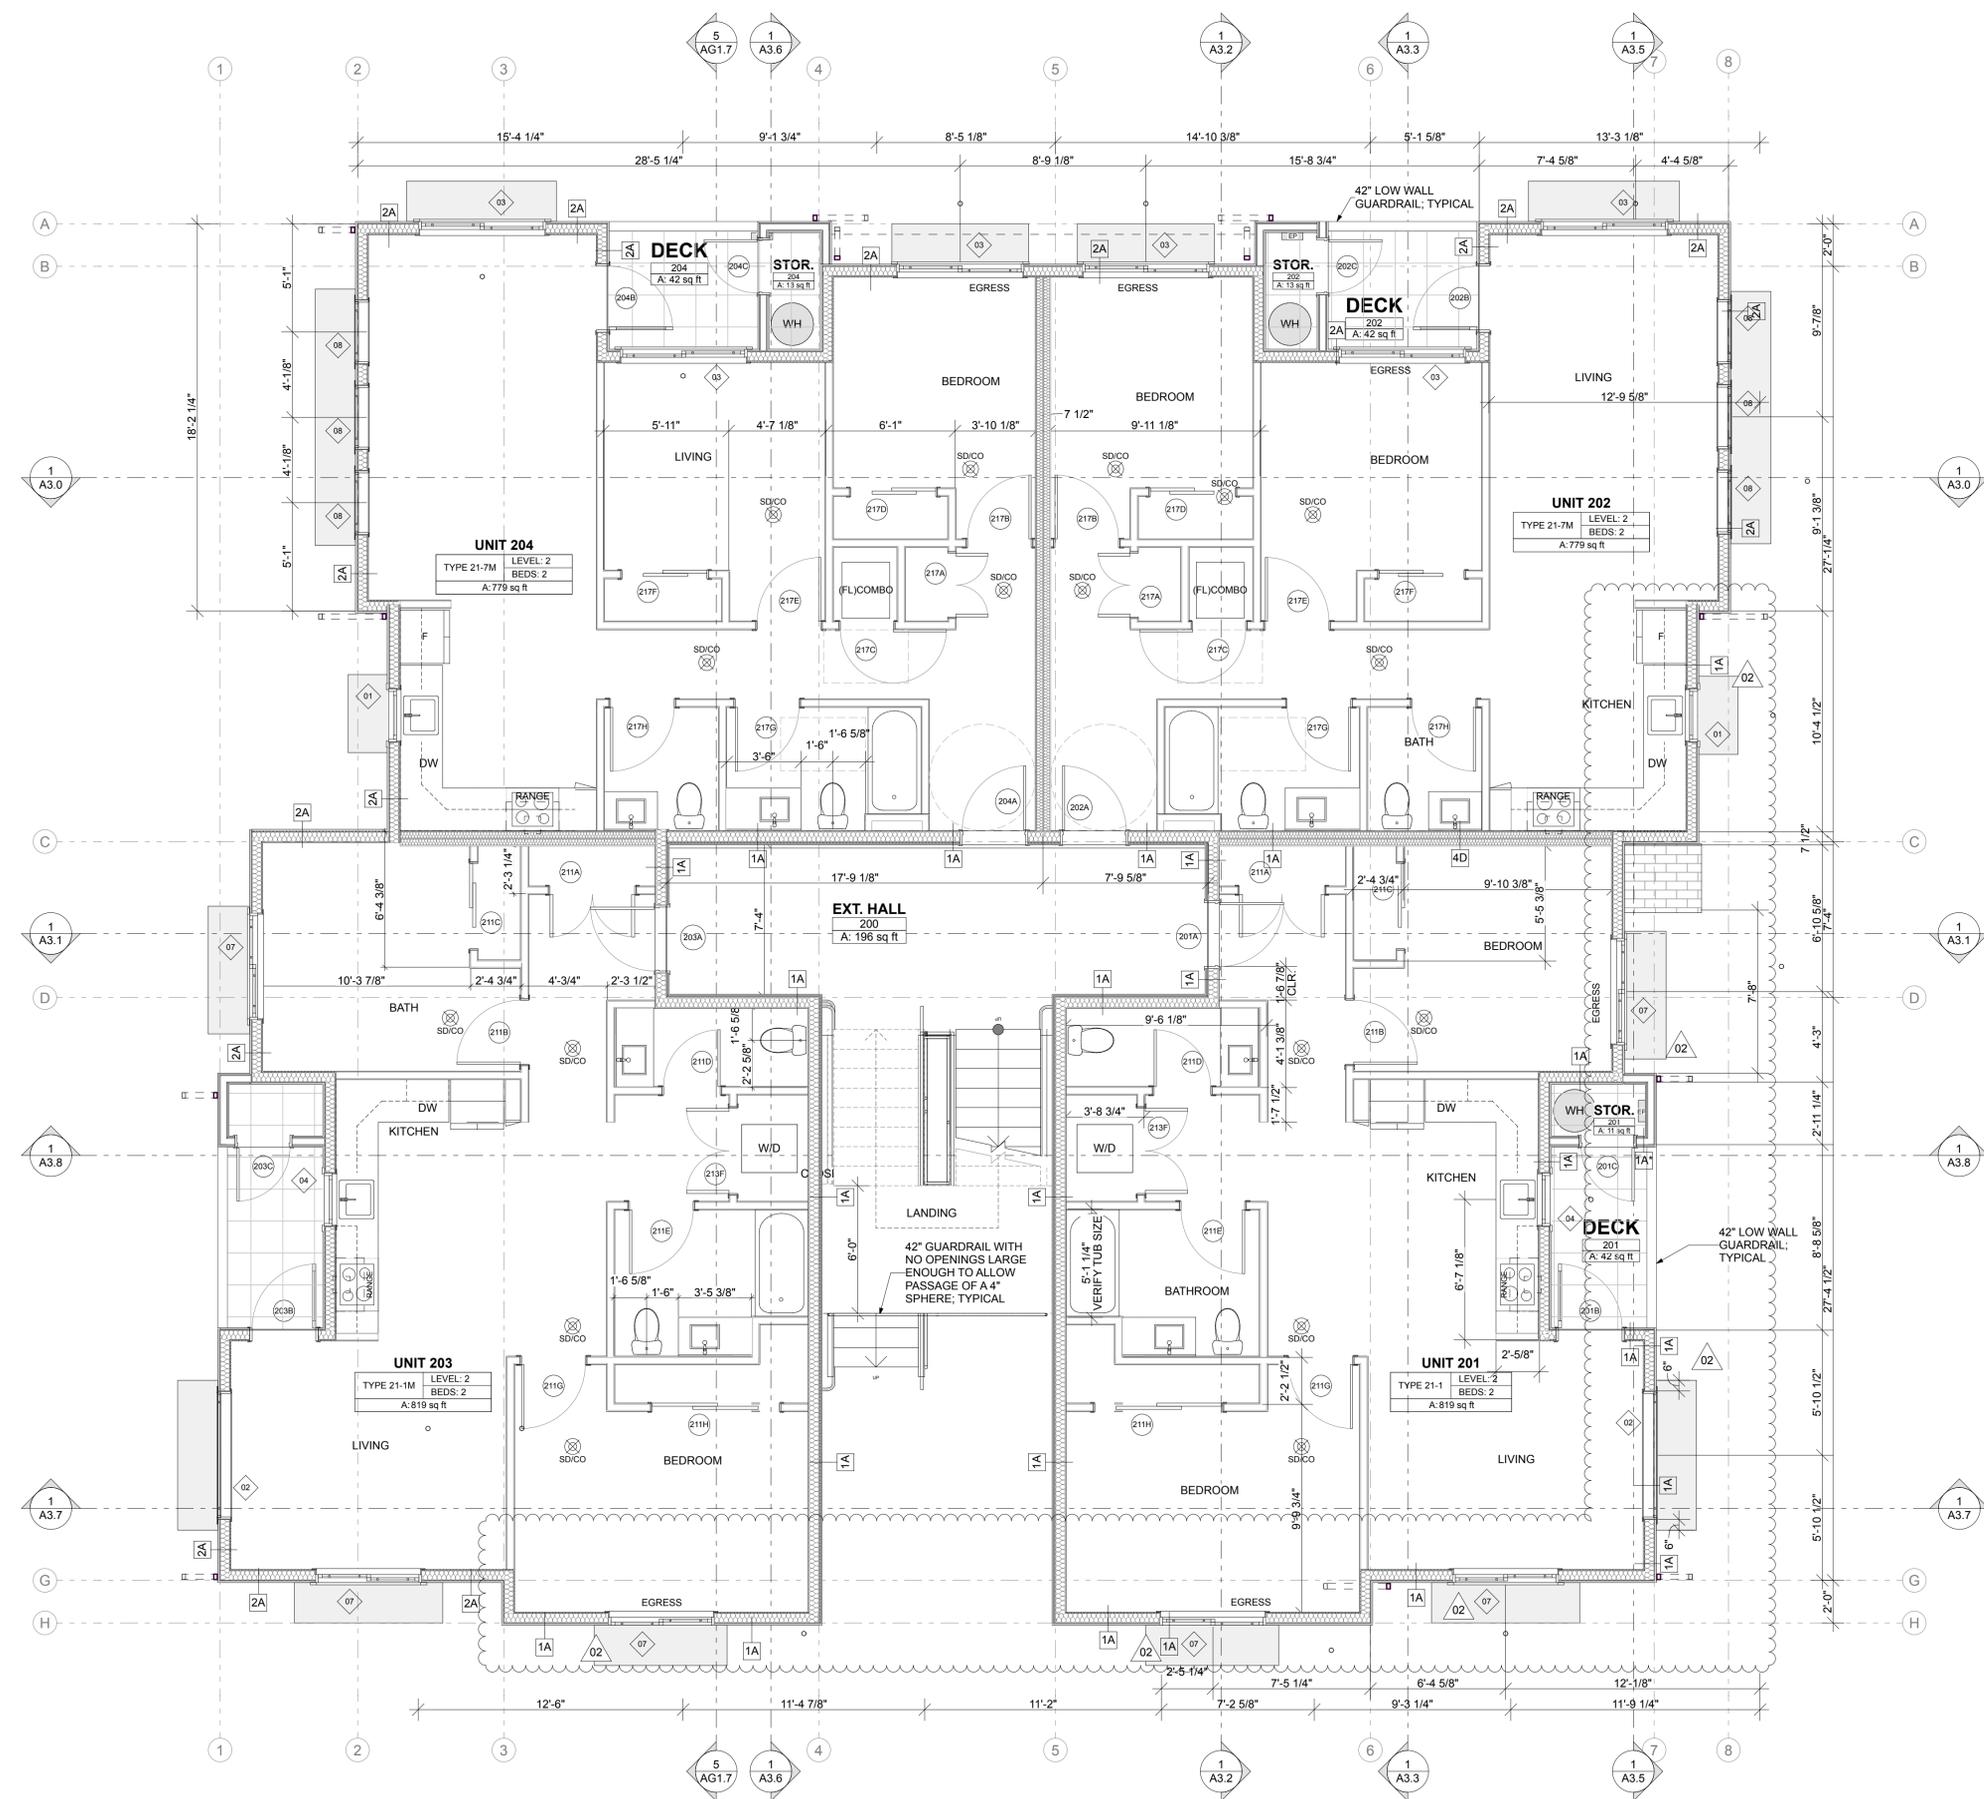


1 LEVEL 2 FLOOR PLAN
SCALE: 1/4" = 1'-0"

AGENCY REVIEW - REVISION No.2 | 25.08.29

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

REVISIONS	
DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	LEVEL 3 FLOOR PLAN
PROJECT #:	2016
SHEET:	

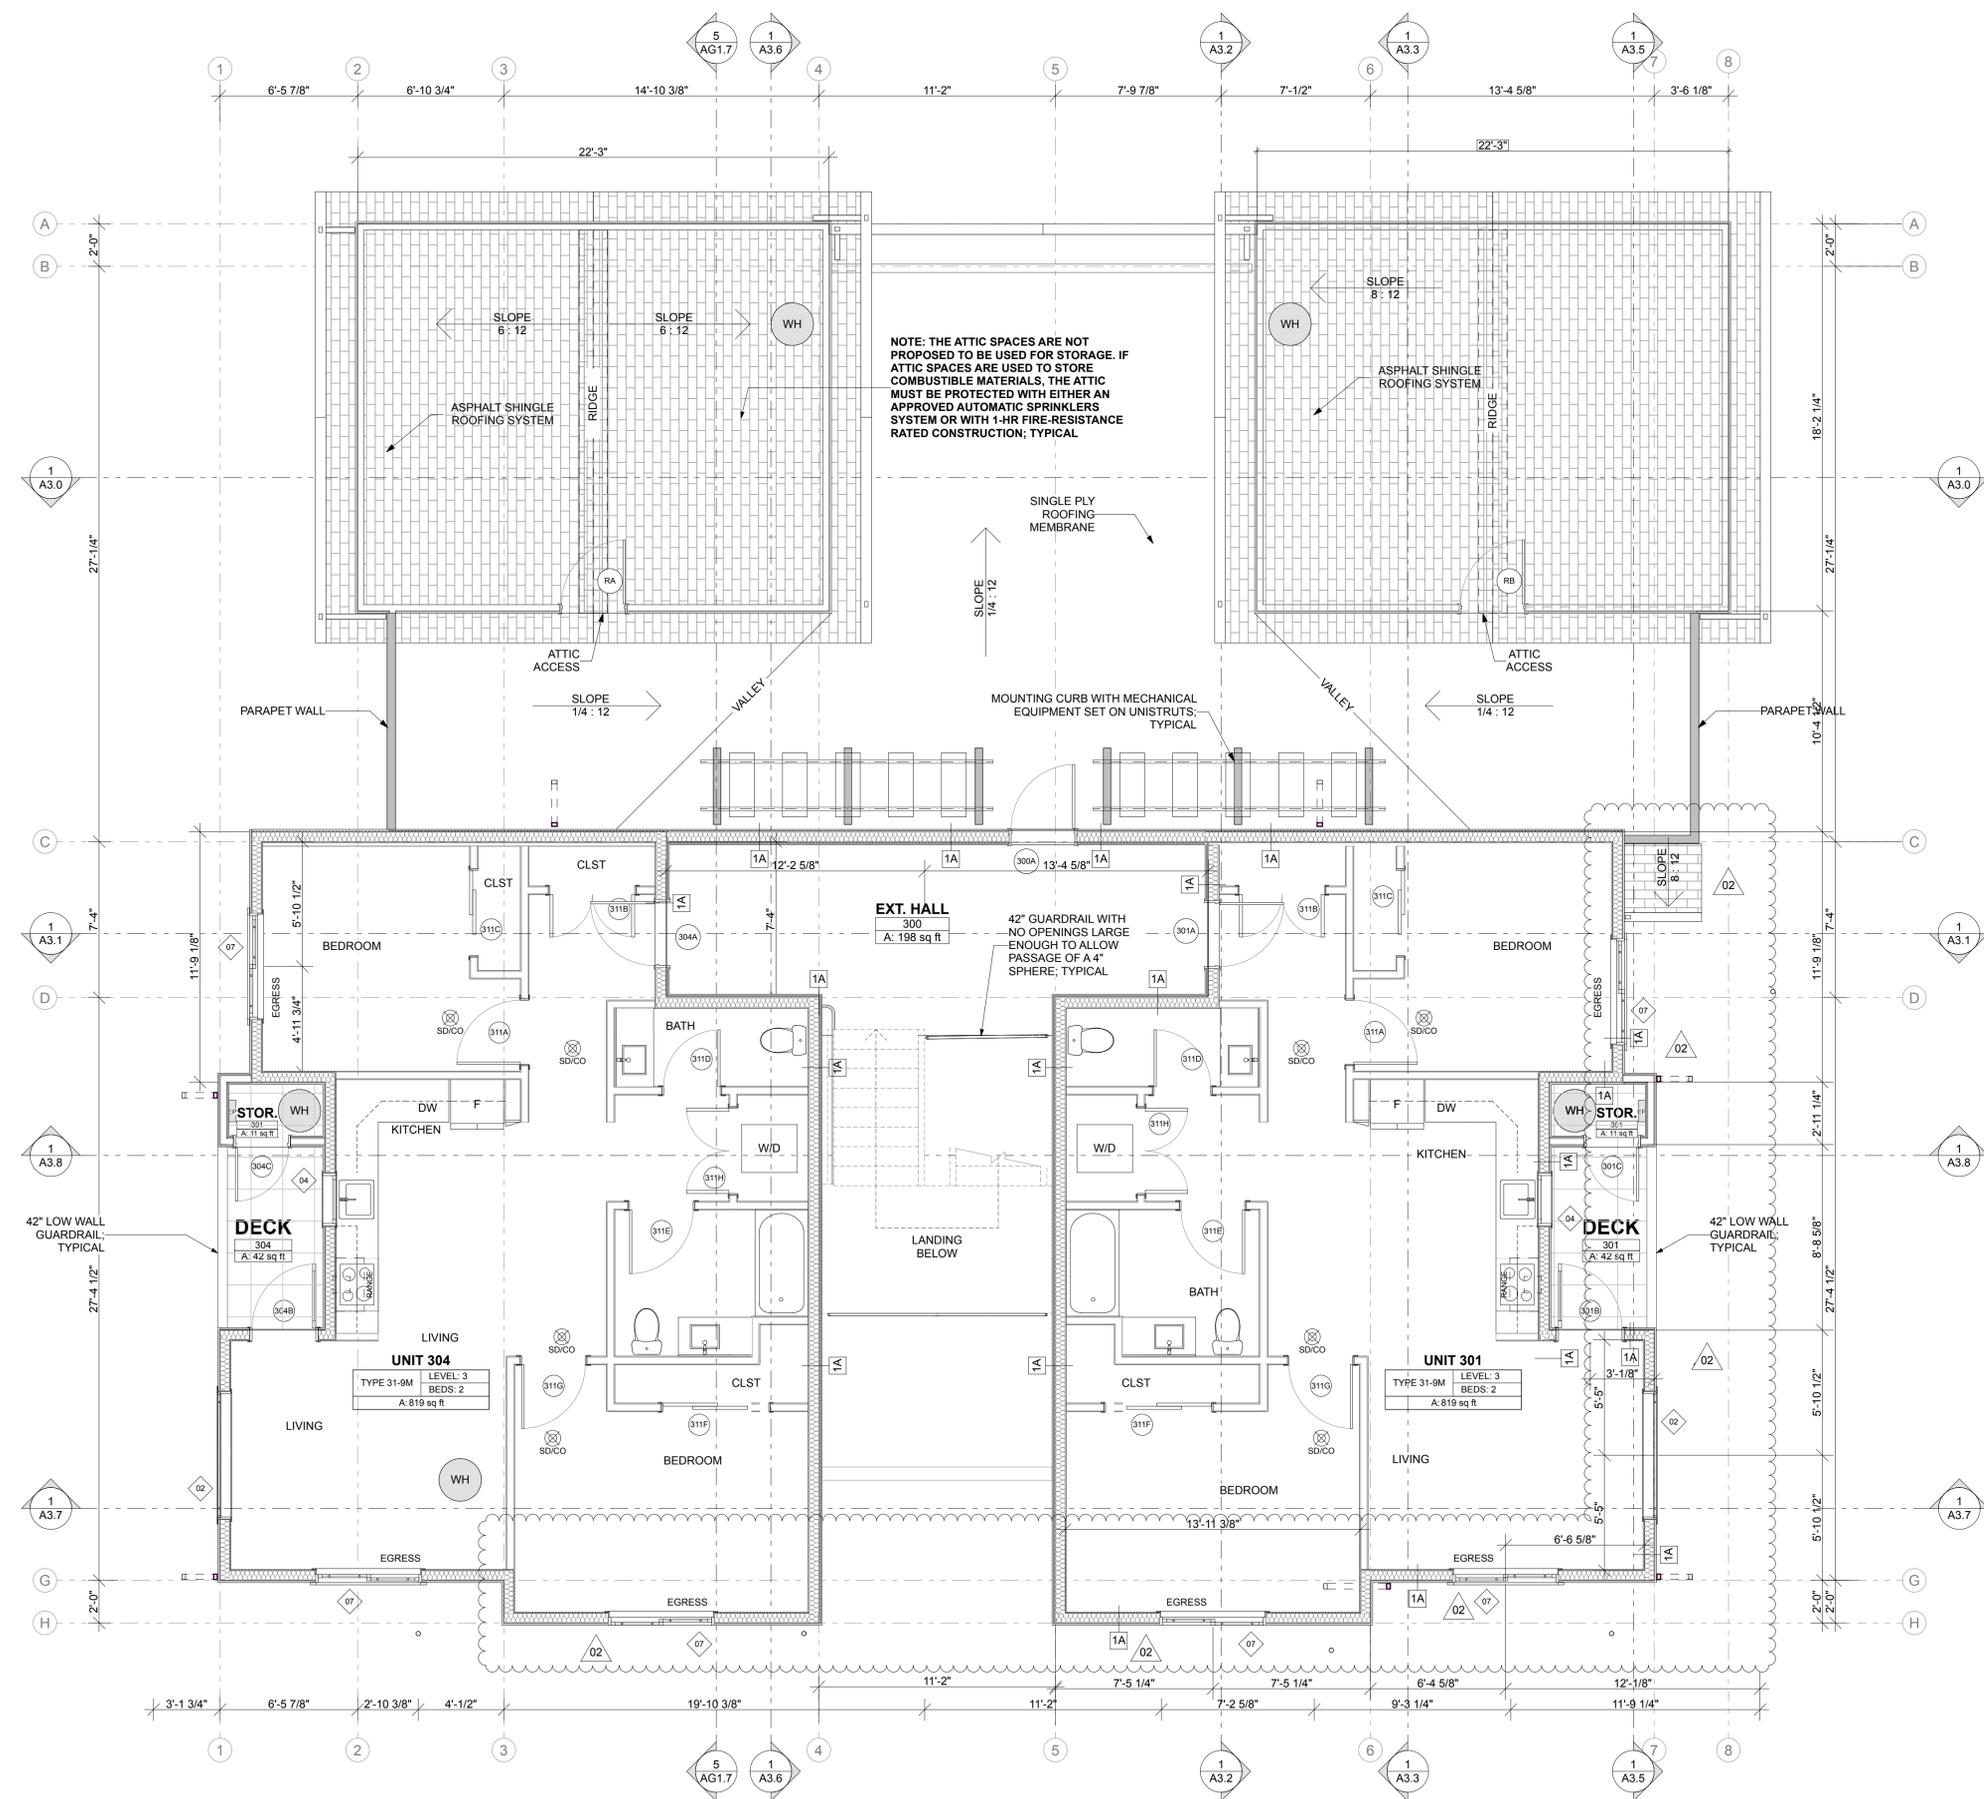

NOTE: THE ATTIC SPACES ARE NOT PROPOSED TO BE USED FOR STORAGE. IF ATTIC SPACES ARE USED TO STORE COMBUSTIBLE MATERIALS, THE ATTIC MUST BE PROTECTED WITH EITHER AN APPROVED AUTOMATIC SPRINKLERS SYSTEM OR WITH 1-HR FIRE-RESISTANCE RATED CONSTRUCTION; TYPICAL

1 LEVEL 3 FLOOR PLAN
SCALE: 1/4" = 1'-0"




AGENCY REVIEW - REVISION No.2 | 25.08.29

REVISIONS	
01	RESPONSE TO 1 ST REVIEW, 2025.08.05
02	RESPONSE TO 2 ND REVIEW, 2025.07.31

REVISIONS	

DRAWN BY: BL / CM
CHECKED BY: BL
DATE: 25.08.29
TITLE: ROOF PLAN
PROJECT #: 2016
SHEET:

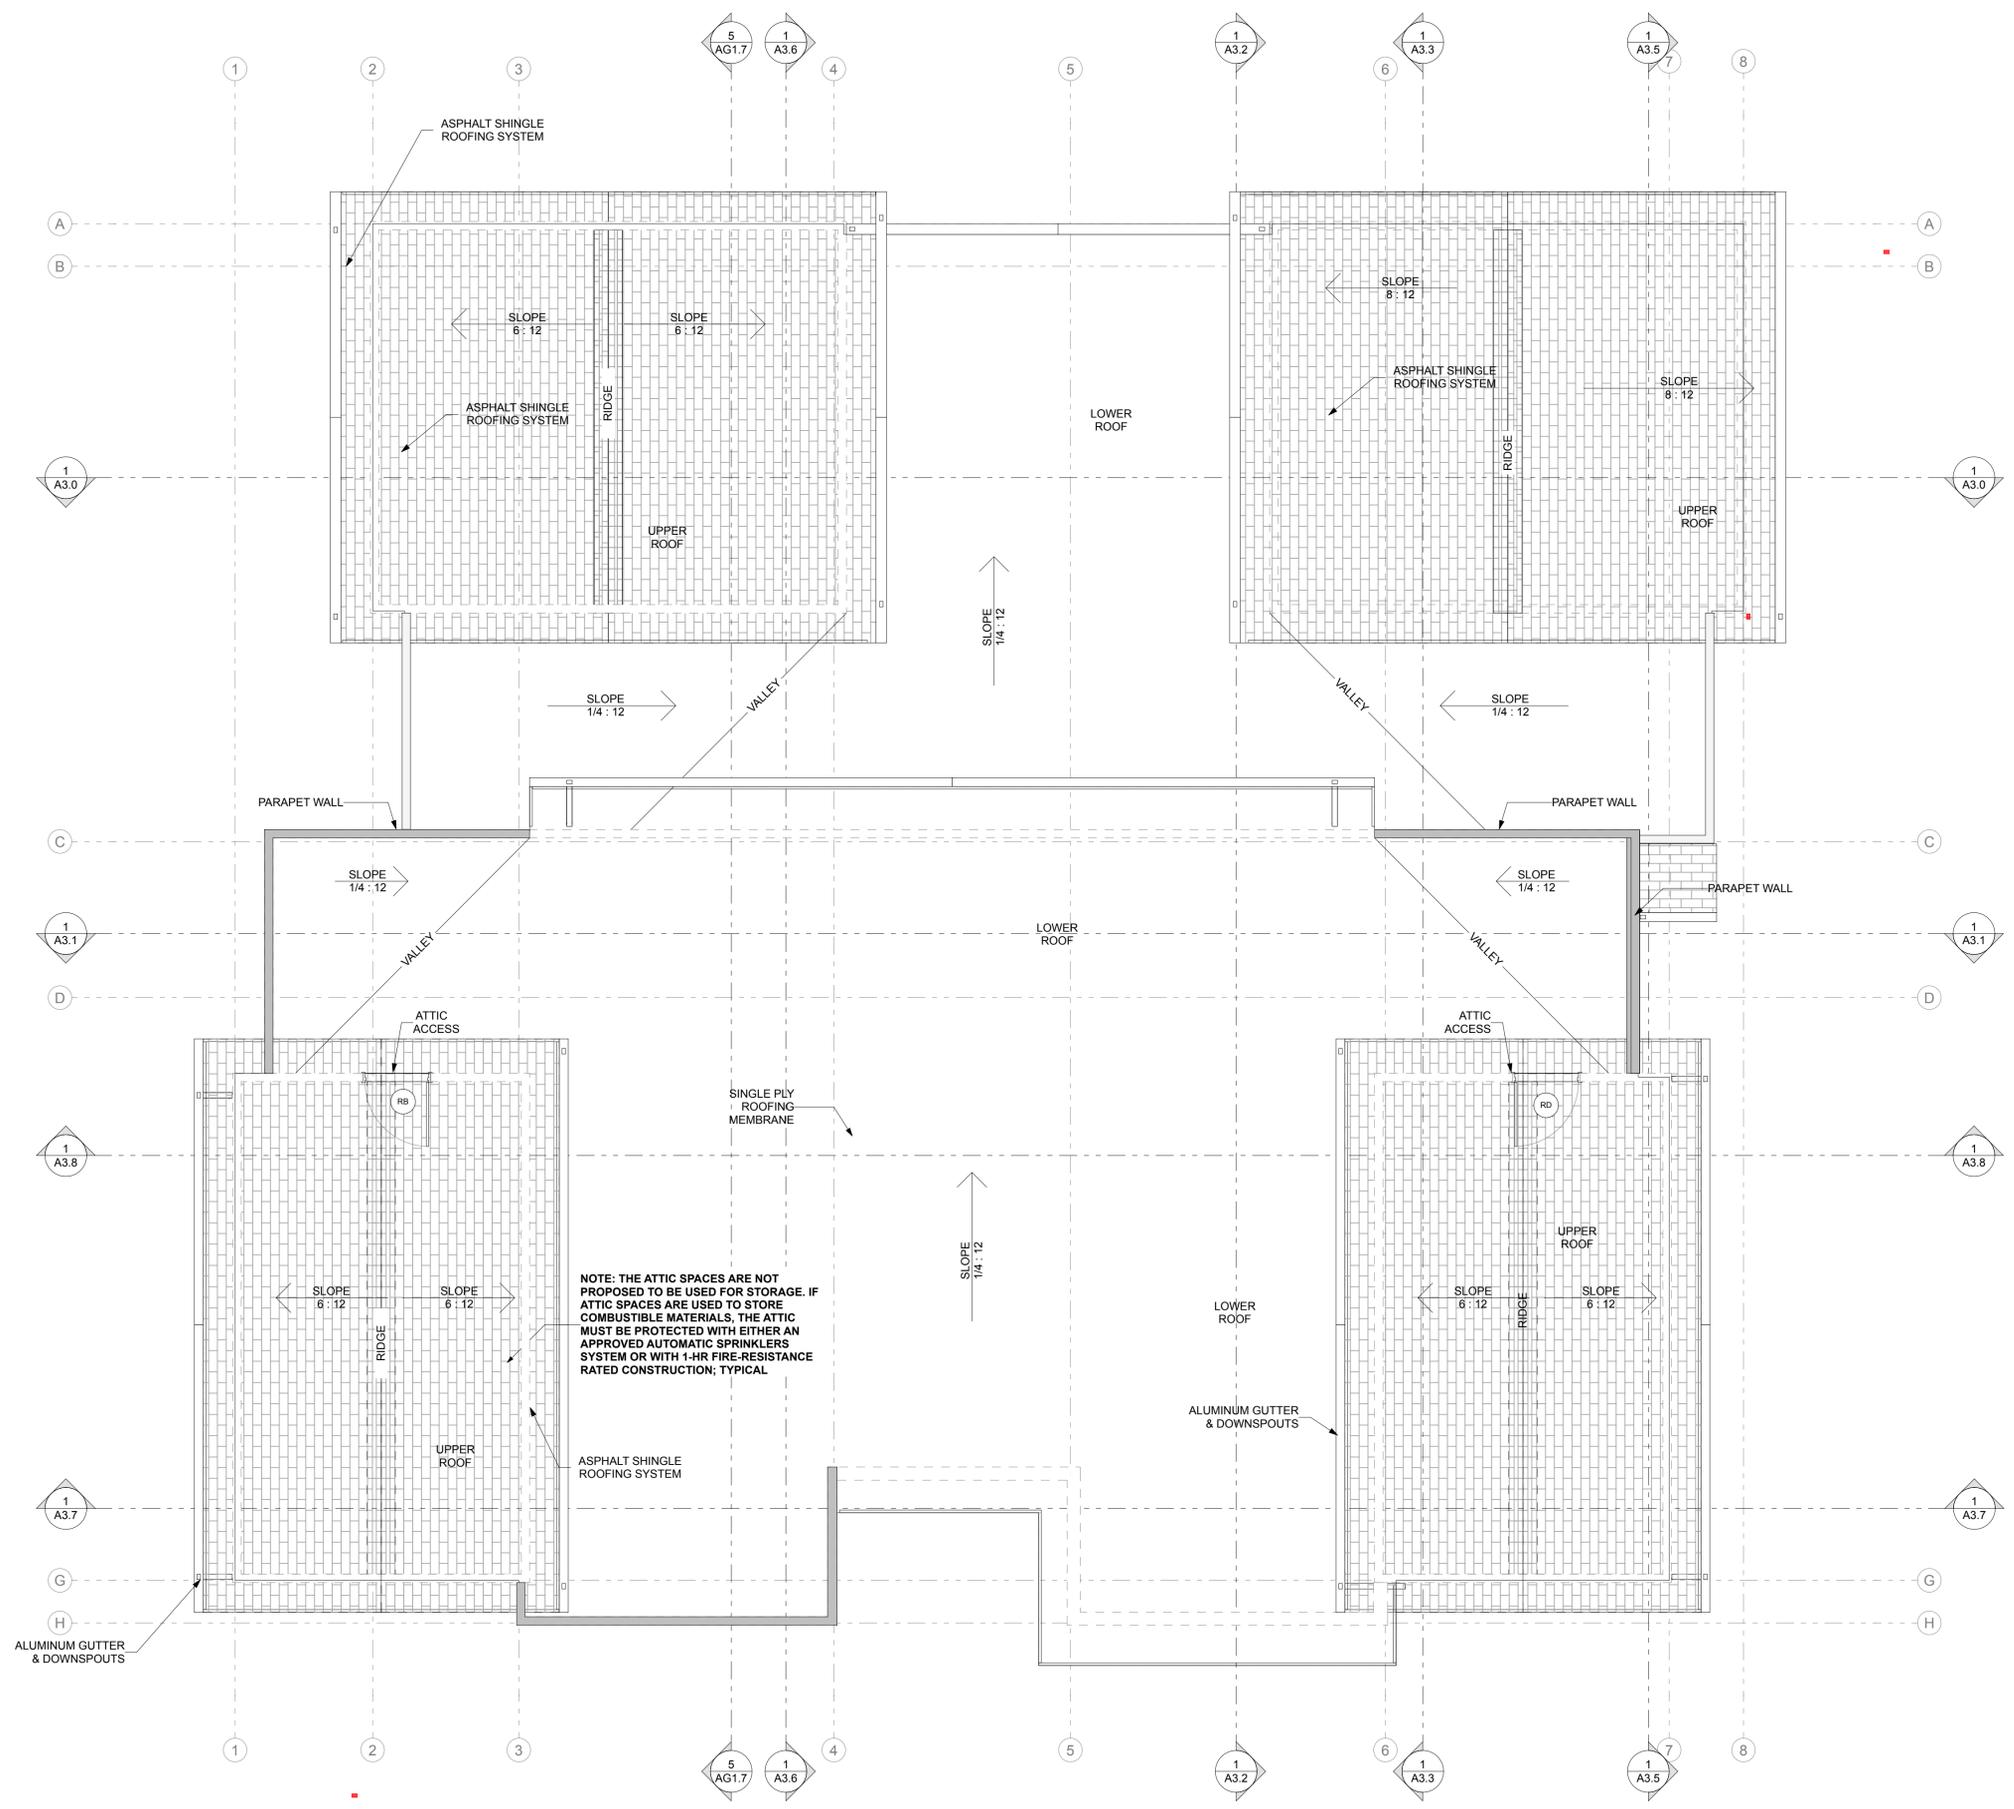


AGENCY REVIEW - REVISION No.2 | 25.08.29

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

REVISIONS	

DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	LEVEL 1 - REFLECTED CEILING PLAN
PROJECT #:	2016
SHEET:	

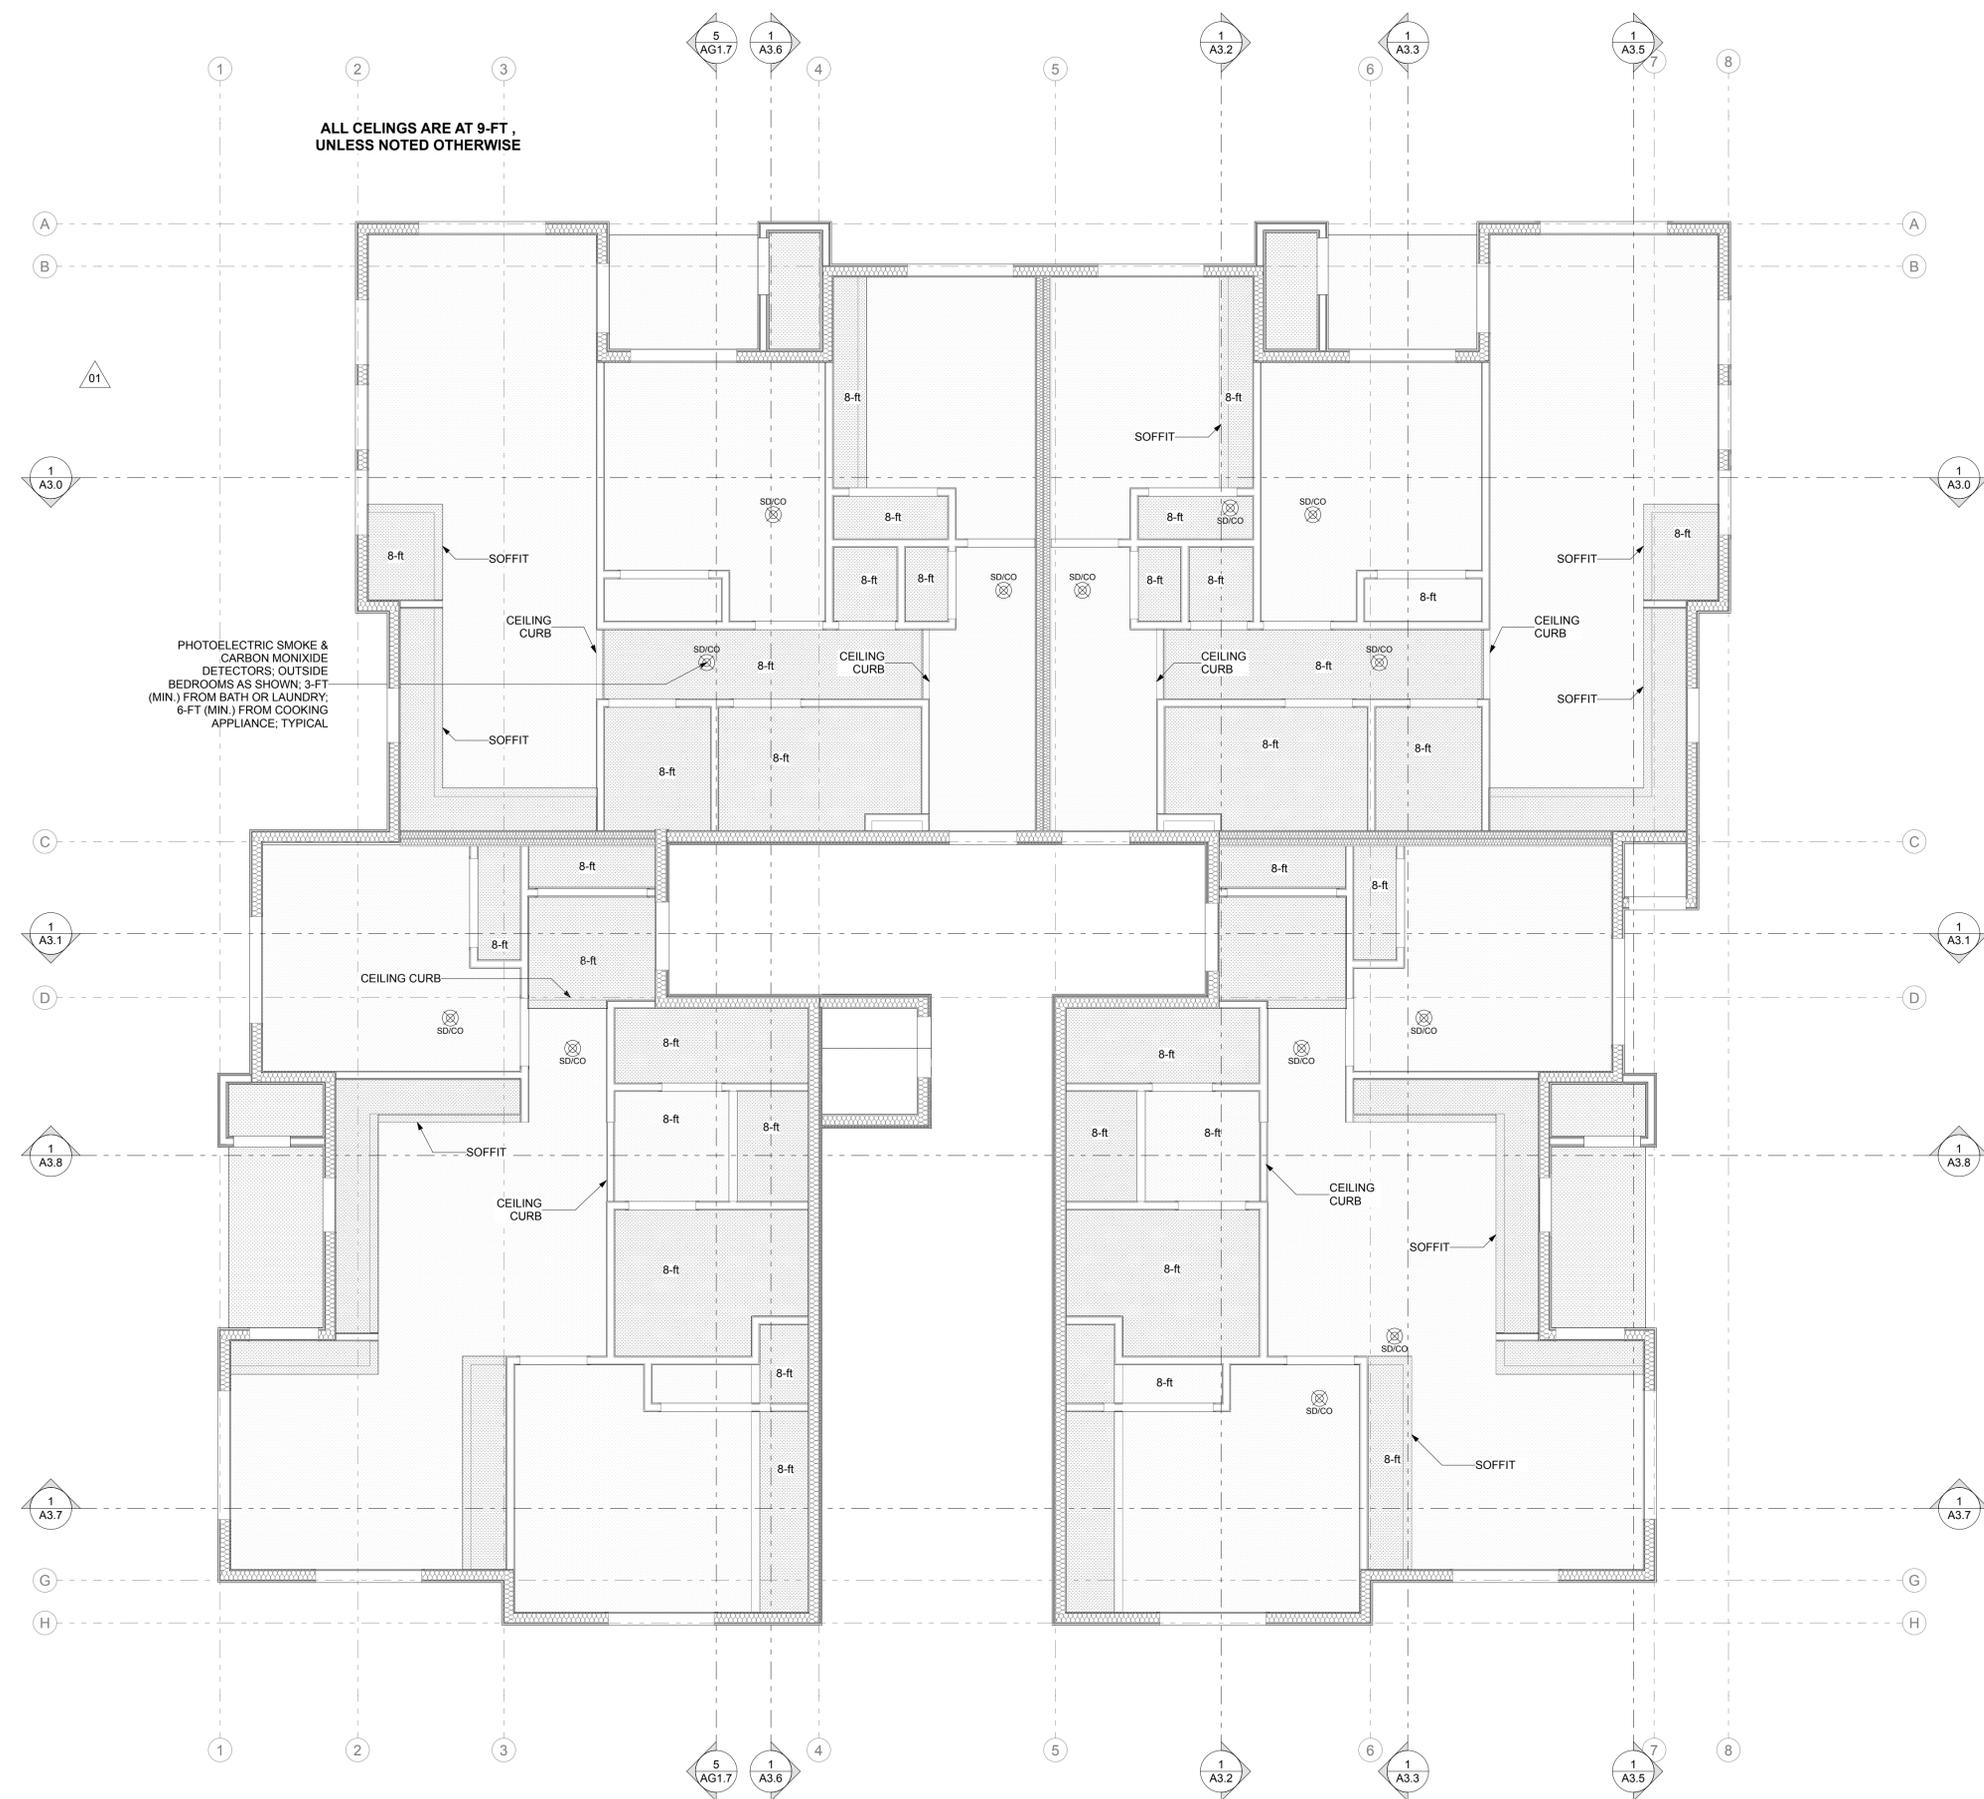

1 LEVEL 1 - REFLECTED CEILING PLAN
SCALE: 1/4" = 1'-0"




AGENCY REVIEW - REVISION No.2 | 25.08.29

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

REVISIONS	


DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	LEVEL 2 - REFLECTED CEILING PLAN
PROJECT #:	2016
SHEET:	

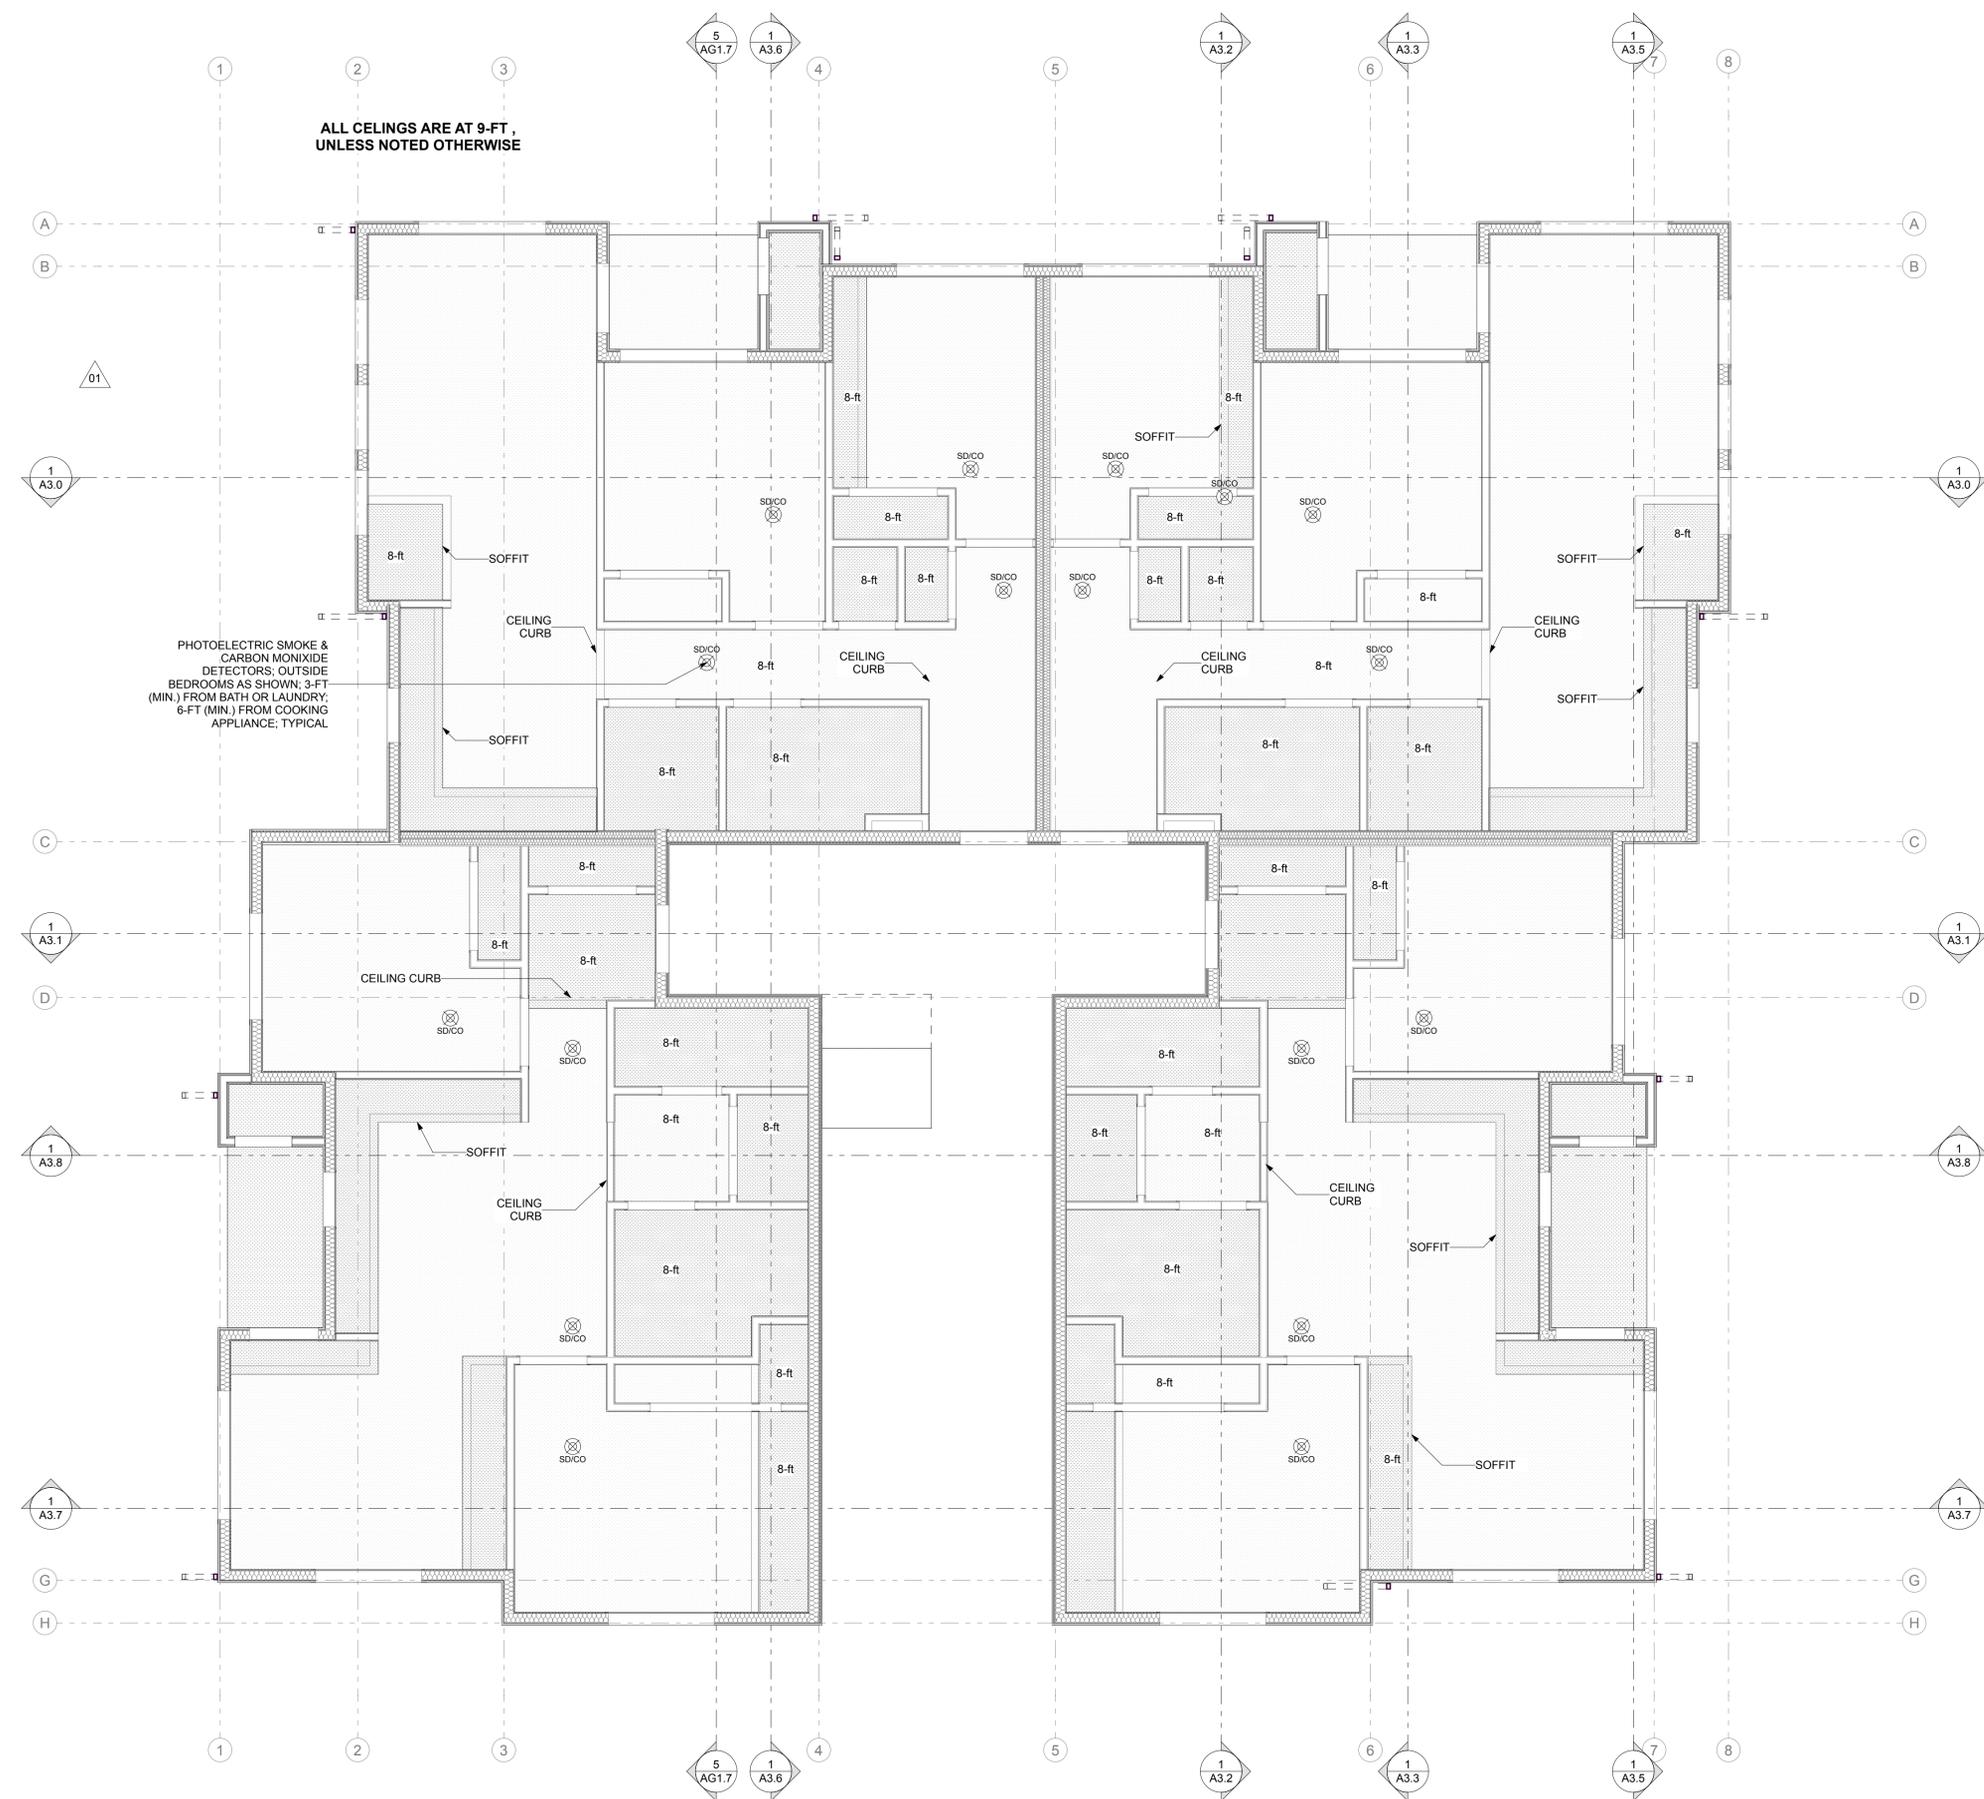

1 LEVEL 2 - REFLECTED CEILING PLAN
SCALE: 1/4" = 1'-0"



AGENCY REVIEW - REVISION No.2 | 25.08.29

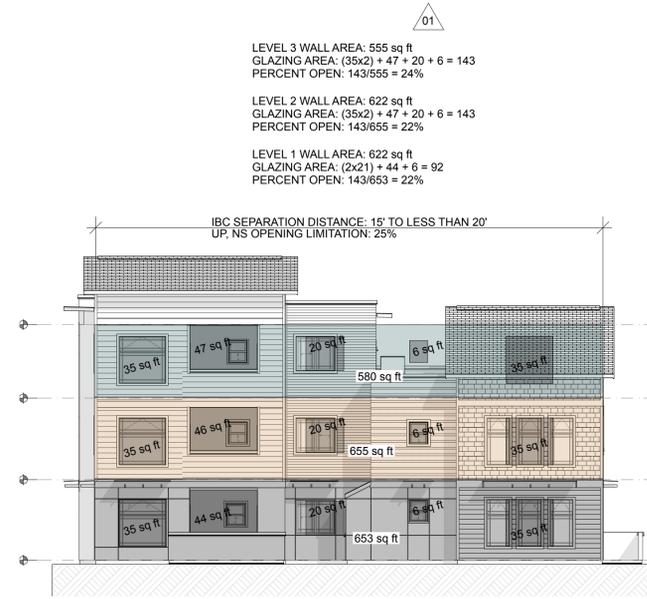

3 SOUTH ELEVATION TRANSPARENCY
SCALE: 3/32" = 1'-0"



1 WEST ELEVATION
SCALE: 3/16" = 1'-0"

BUILDING REFERENCE NOTES

- 01 WINDOW OR DOOR ASSEMBLY PER PLAN
- 02 ASPHALT SHINGLES OVER UNDERLAYMENT
- 03 EXTERIOR CLADDING; NOTE ALL EXTERIOR WALL ASSEMBLIES INCORPORATE A 'RAINSCREEN' SYSTEM
 - 3-A HARDIE-PLANK WITH 7.25" EXPOSURE (OR APPROVED SUBSTITUTE)
 - 3-B HARDIE-PLANK WITH 4" EXPOSURE (OR APPROVED SUBSTITUTE)
 - 3-C HARDIE-PLANK WITH ALTERNATING 4" & 7.25" EXPOSURE
 - 3-D HARDIE-PANEL (4x8 MAX. SIZE) WITH PRIMED-TO-BE-PAINTED ALUMINUM REVEALS (OR APPROVED SUBSTITUTE)
 - 3-E HARDIE-PANEL & BATTENS (OR APPROVED SUBSTITUTE)
 - 3-F HARDIE-STRAIGHT SHINGLE (OR APPROVED EQUAL)
- 04 WINDOW TREATMENT - 3.5" WIDE (MINIMUM) CEMENT BOARD WINDOW AND DOOR TRIM
- 05 CEMENT FIBERBOARD, HORIZONTAL TRIM BOARD. SIZE VARIES.
- 06 CEMENT FIBERBOARD, VERTICAL TRIM BOARD. SIZE VARIES.
- 07 CEMENT FIBERBOARD, 5.5" WIDE FASCIA BOARD.
- 08 42" TALL, PRE-FINISHED ALUMINUM GUARDRAILS W/ FACE-MOUNT CONNECTION TO STRUCTURE
- 09 SINGLE-PLY ROOFING MEMBRANE
- 10 PRIMED, TO BE PAINTED, GUTTER / DOWNSPOUT. PAINT SAME COLOR AS FASCIA OR WALL UPON WHICH IT IS MOUNTED.
- 11 BAFFLED RIDGE VENT OR BAFFLED SIDEWALL VENT
- 12 PRIMED, TO BE PAINTED, 22 GA. SHEET METAL, PARAPET CAP OR WALL CAP. PAINT SAME COLOR AS PARAPET OR WALL.
- 13 MECHANICAL EQUIPMENT
- 14 AWNING (N.Y.D.)



2 SOUTH ELEVATION
SCALE: 3/16" = 1'-0"

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31


REVISIONS	

DRAWN BY: BL / CM
CHECKED BY: BL
DATE: 25.08.29
TITLE: BUILDING ELEVATIONS
PROJECT #: 2016
SHEET:

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

REVISIONS	

DRAWN BY: BL / CM
CHECKED BY: BL
DATE: 25.08.29
TITLE: BUILDING ELEVATIONS
PROJECT #: 2016
SHEET:

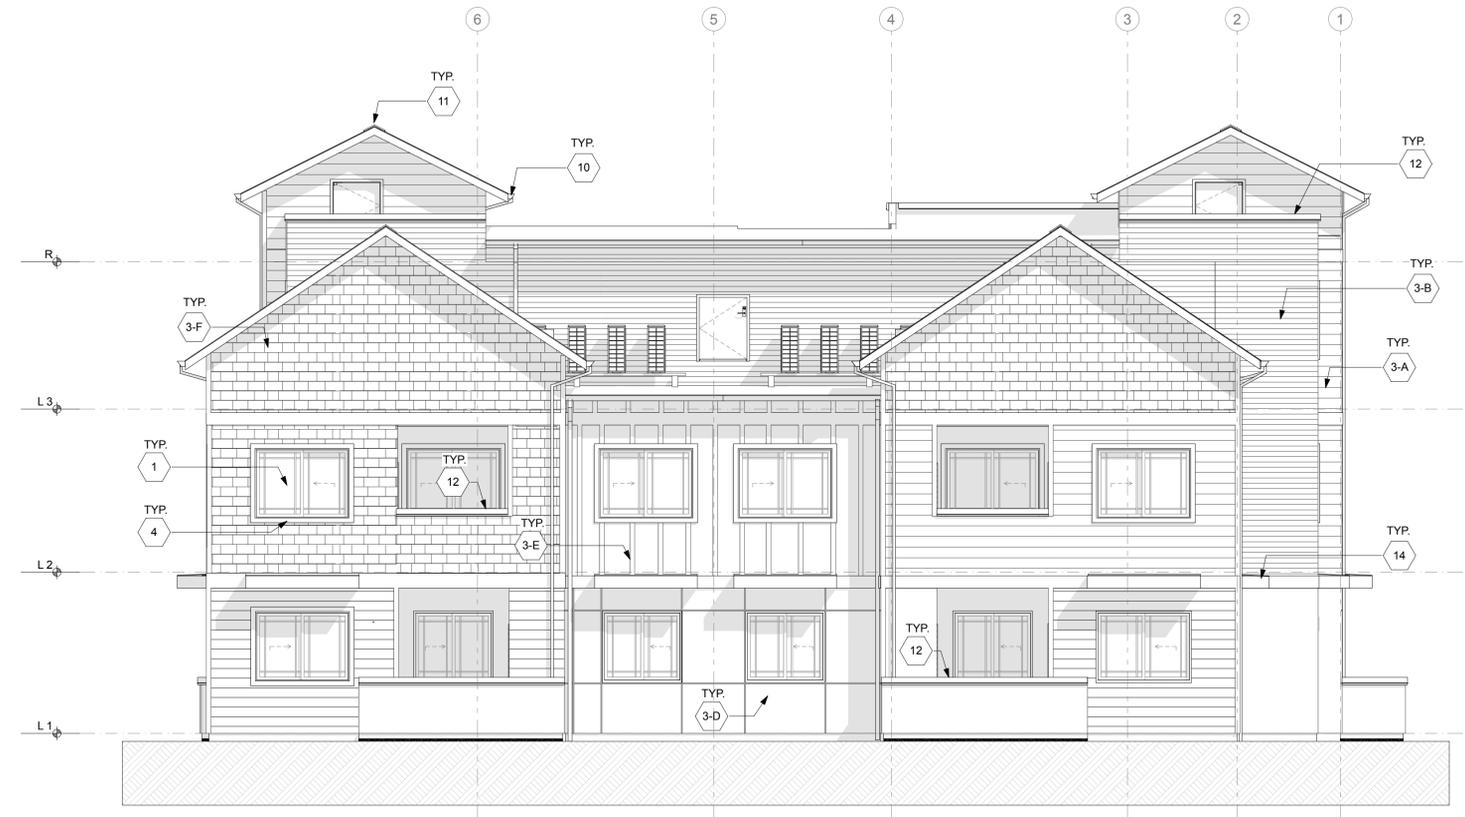


1 EAST ELEVATION
SCALE: 3/16" = 1'-0"



2 NORTH ELEVATION
SCALE: 3/16" = 1'-0"

BUILDING REFERENCE NOTES

- 01 WINDOW OR DOOR ASSEMBLY PER PLAN
- 02 ASPHALT SHINGLES OVER UNDERLAYMENT
- 03 EXTERIOR CLADDING; NOTE ALL EXTERIOR WALL ASSEMBLIES INCORPORATE A 'RAINSCREEN' SYSTEM
 - 3-A HARDIE-PLANK WITH 7.25" EXPOSURE (OR APPROVED SUBSTITUTE)
 - 3-B HARDIE-PLANK WITH 4" EXPOSURE (OR APPROVED SUBSTITUTE)
 - 3-C HARDIE-PLANK WITH ALTERNATING 4" & 7.25" EXPOSURE
 - 3-D HARDIE-PANEL (4x8 MAX. SIZE) WITH PRIMED-TO-BE-PAINTED ALUMINUM REVEALS (OR APPROVED SUBSTITUTE)
 - 3-E HARDIE-PANEL & BATTENS (OR APPROVED SUBSTITUTE)
 - 3-F HARDIE-STRAIGHT SHINGLE (OR APPROVED EQUAL)
- 04 WINDOW TREATMENT - 3.5" WIDE (MINIMUM) CEMENT BOARD WINDOW AND DOOR TRIM
- 05 CEMENT FIBERBOARD, HORIZONTAL TRIM BOARD. SIZE VARIES.
- 06 CEMENT FIBERBOARD, VERTICAL TRIM BOARD. SIZE VARIES.
- 07 CEMENT FIBERBOARD, 5.5" WIDE FASCIA BOARD.
- 08 42" TALL, PRE-FINISHED ALUMINUM GUARDRAILS W/ FACE-MOUNT CONNECTION TO STRUCTURE
- 09 SINGLE-PLY ROOFING MEMBRANE
- 10 PRIMED, TO BE PAINTED, GUTTER / DOWNSPOUT. PAINT SAME COLOR AS FASCIA OR WALL UPON WHICH IT IS MOUNTED.
- 11 BAFFLED RIDGE VENT OR BAFFLED SIDEWALL VENT
- 12 PRIMED, TO BE PAINTED, 22 GA. SHEET METAL, PARAPET CAP OR WALL CAP. PAINT SAME COLOR AS PARAPET OR WALL.
- 13 MECHANICAL EQUIPMENT
- 14 AWNING (N.Y.D.)

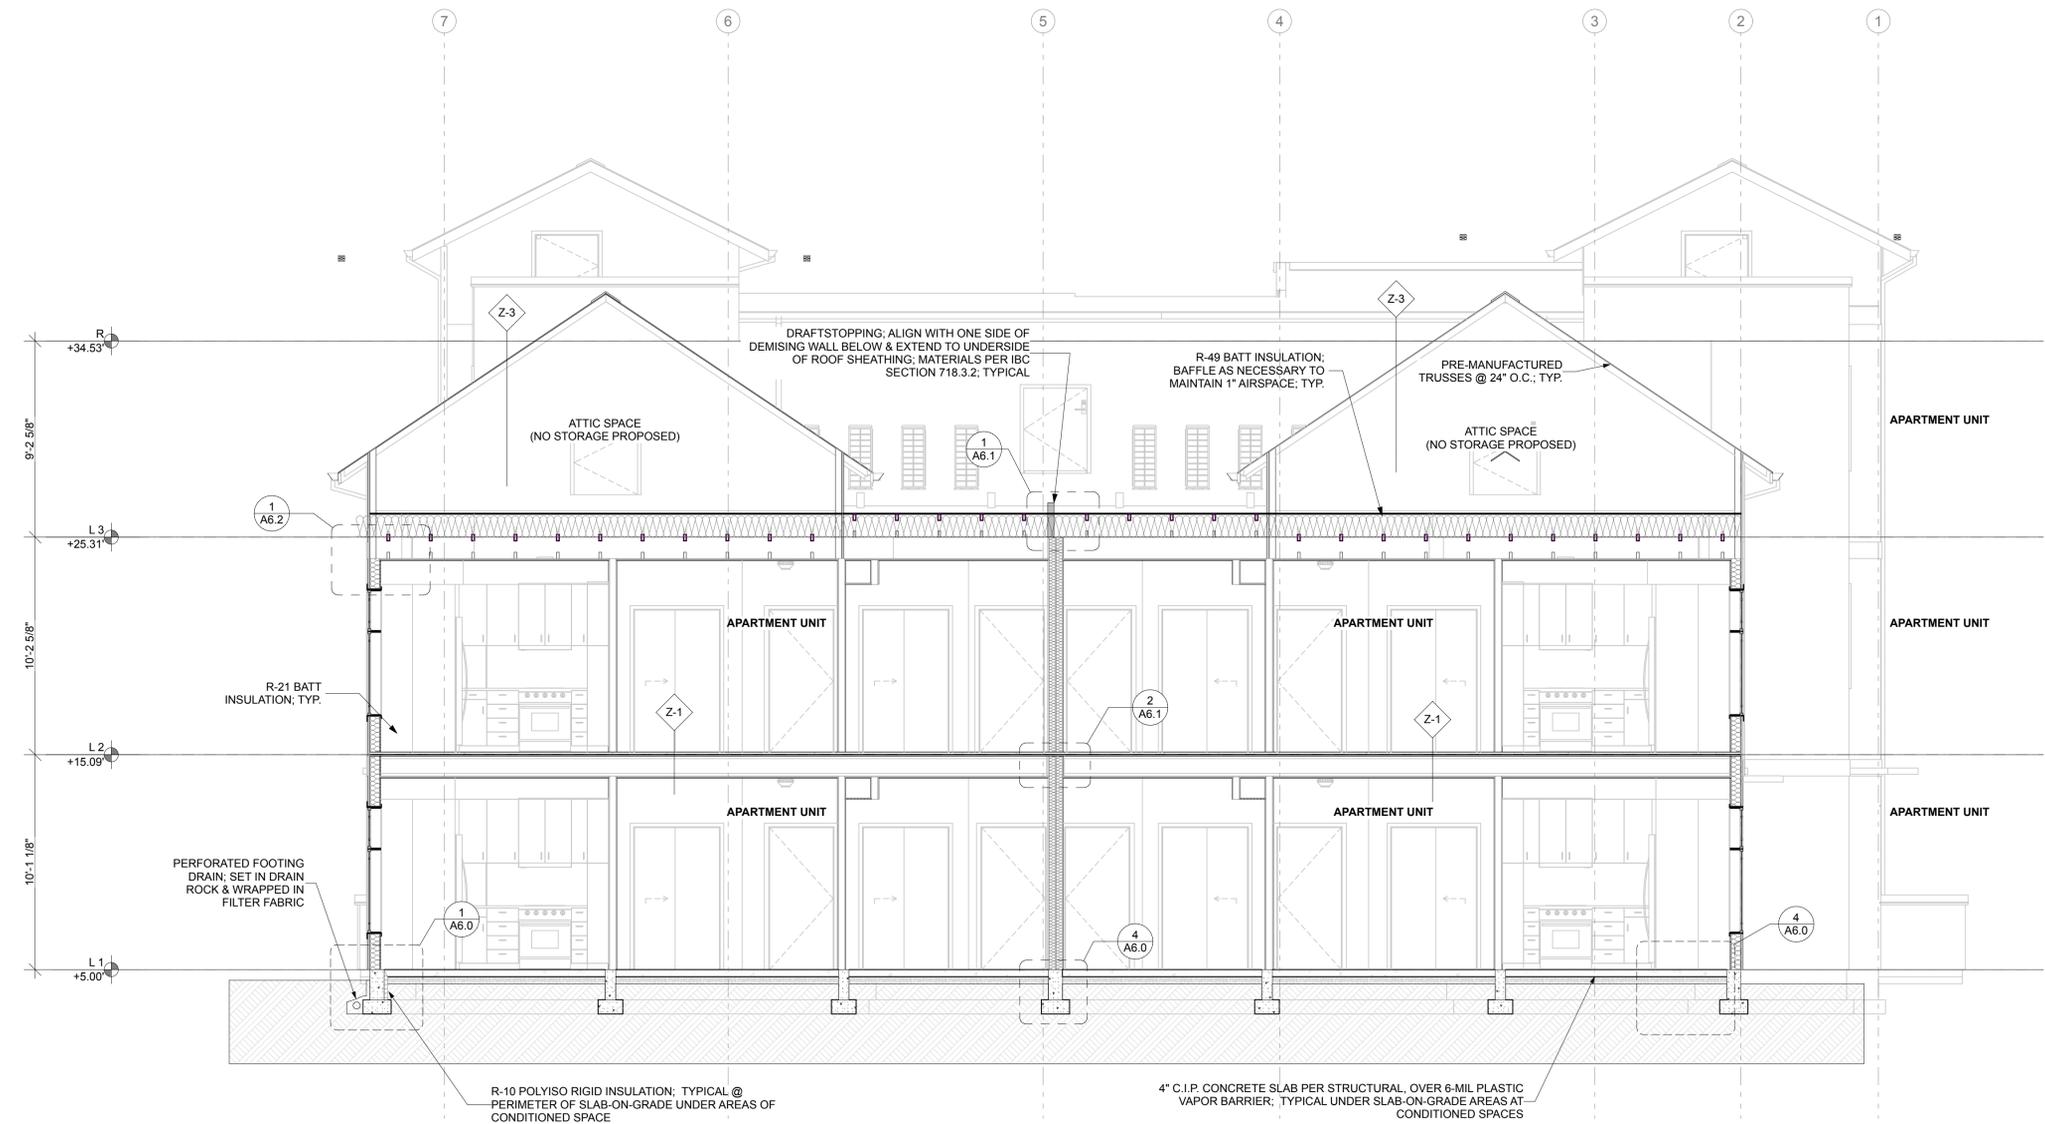


1 BUILDING SECTION 1 ⁰¹
SCALE: 1/4" = 1'-0"

REVISIONS

01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

REVISIONS


DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	BUILDING SECTIONS
PROJECT #:	2016
SHEET:	

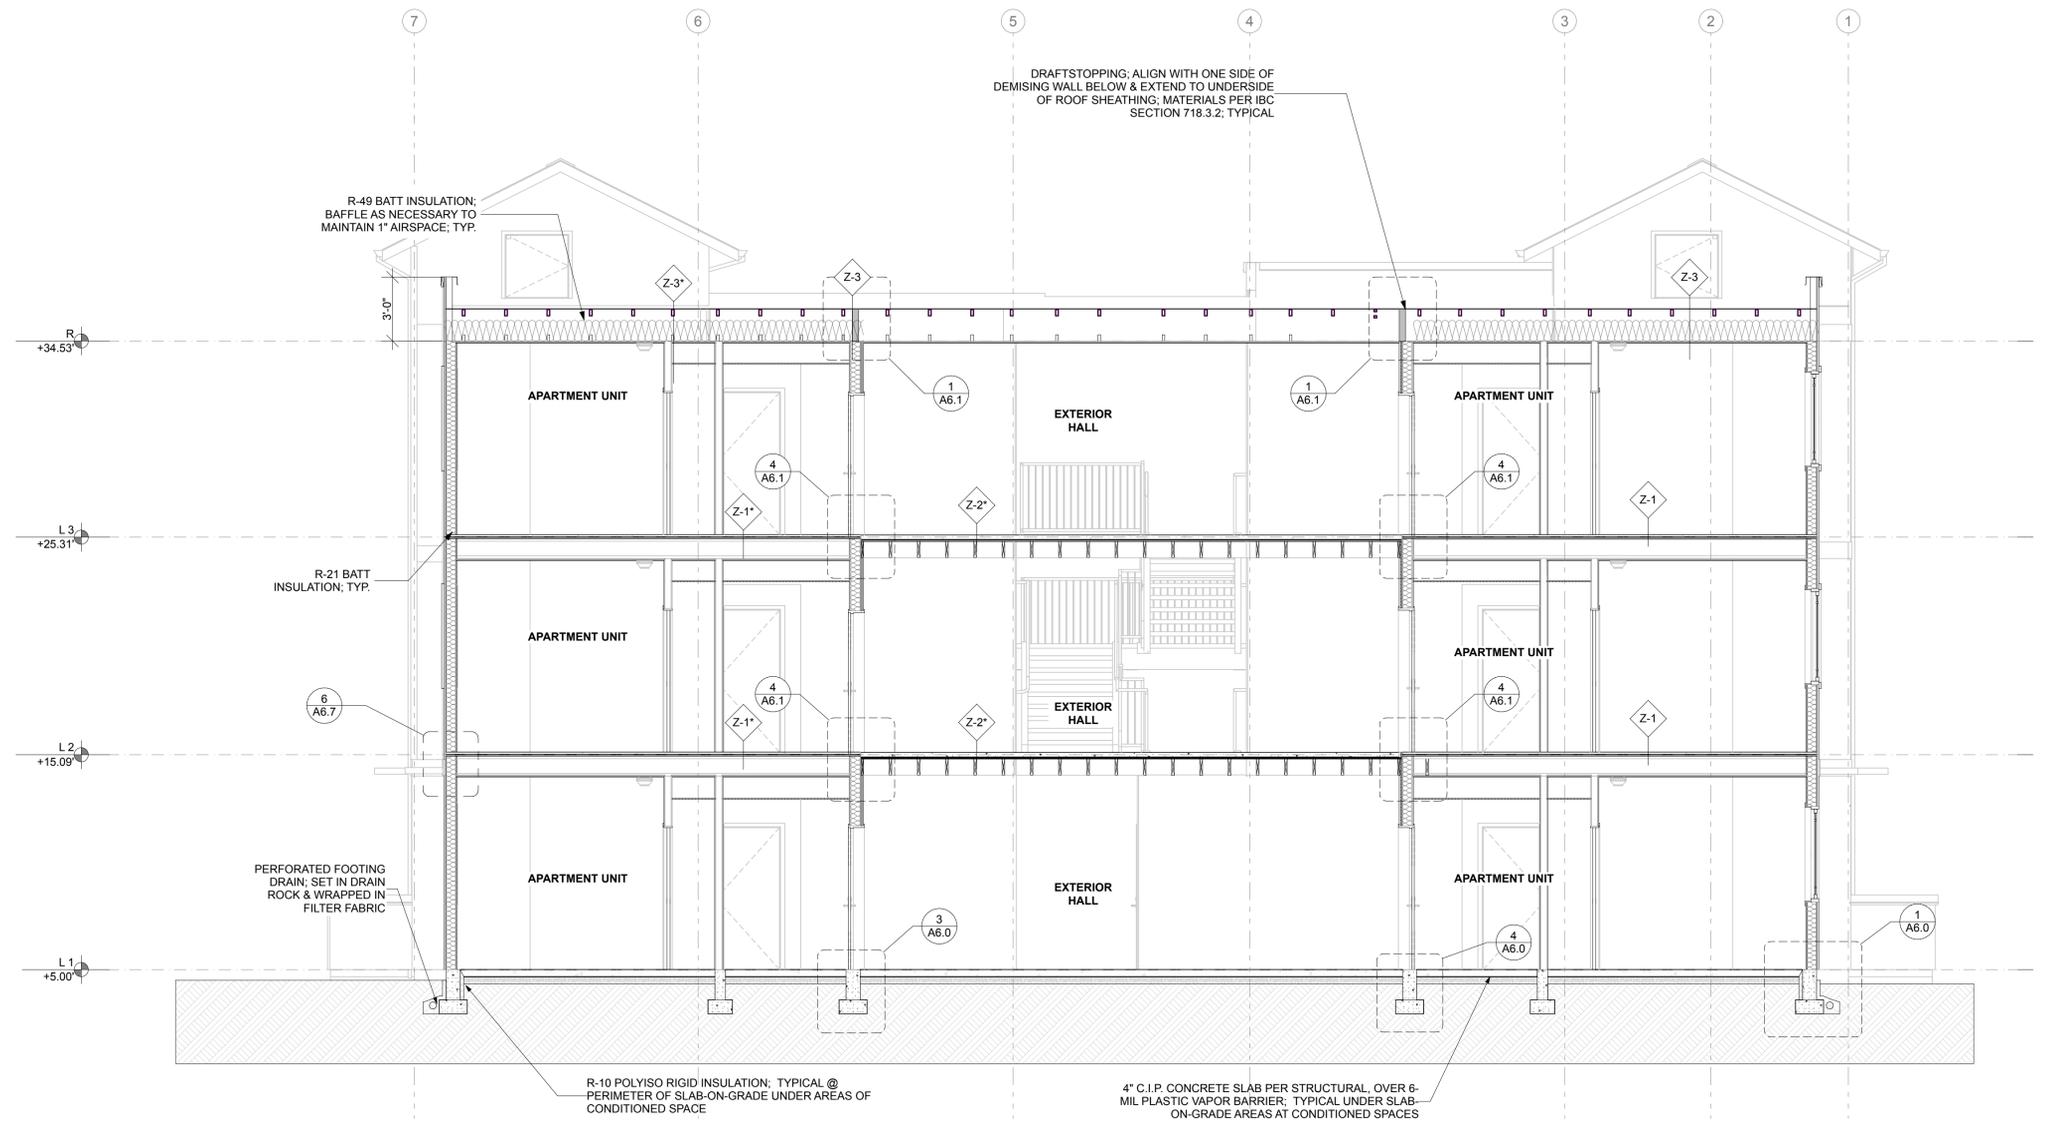

1 BUILDING SECTION 2
SCALE: 1/4" = 1'-0"

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31


REVISIONS	
DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	BUILDING SECTIONS
PROJECT #:	2016
SHEET:	

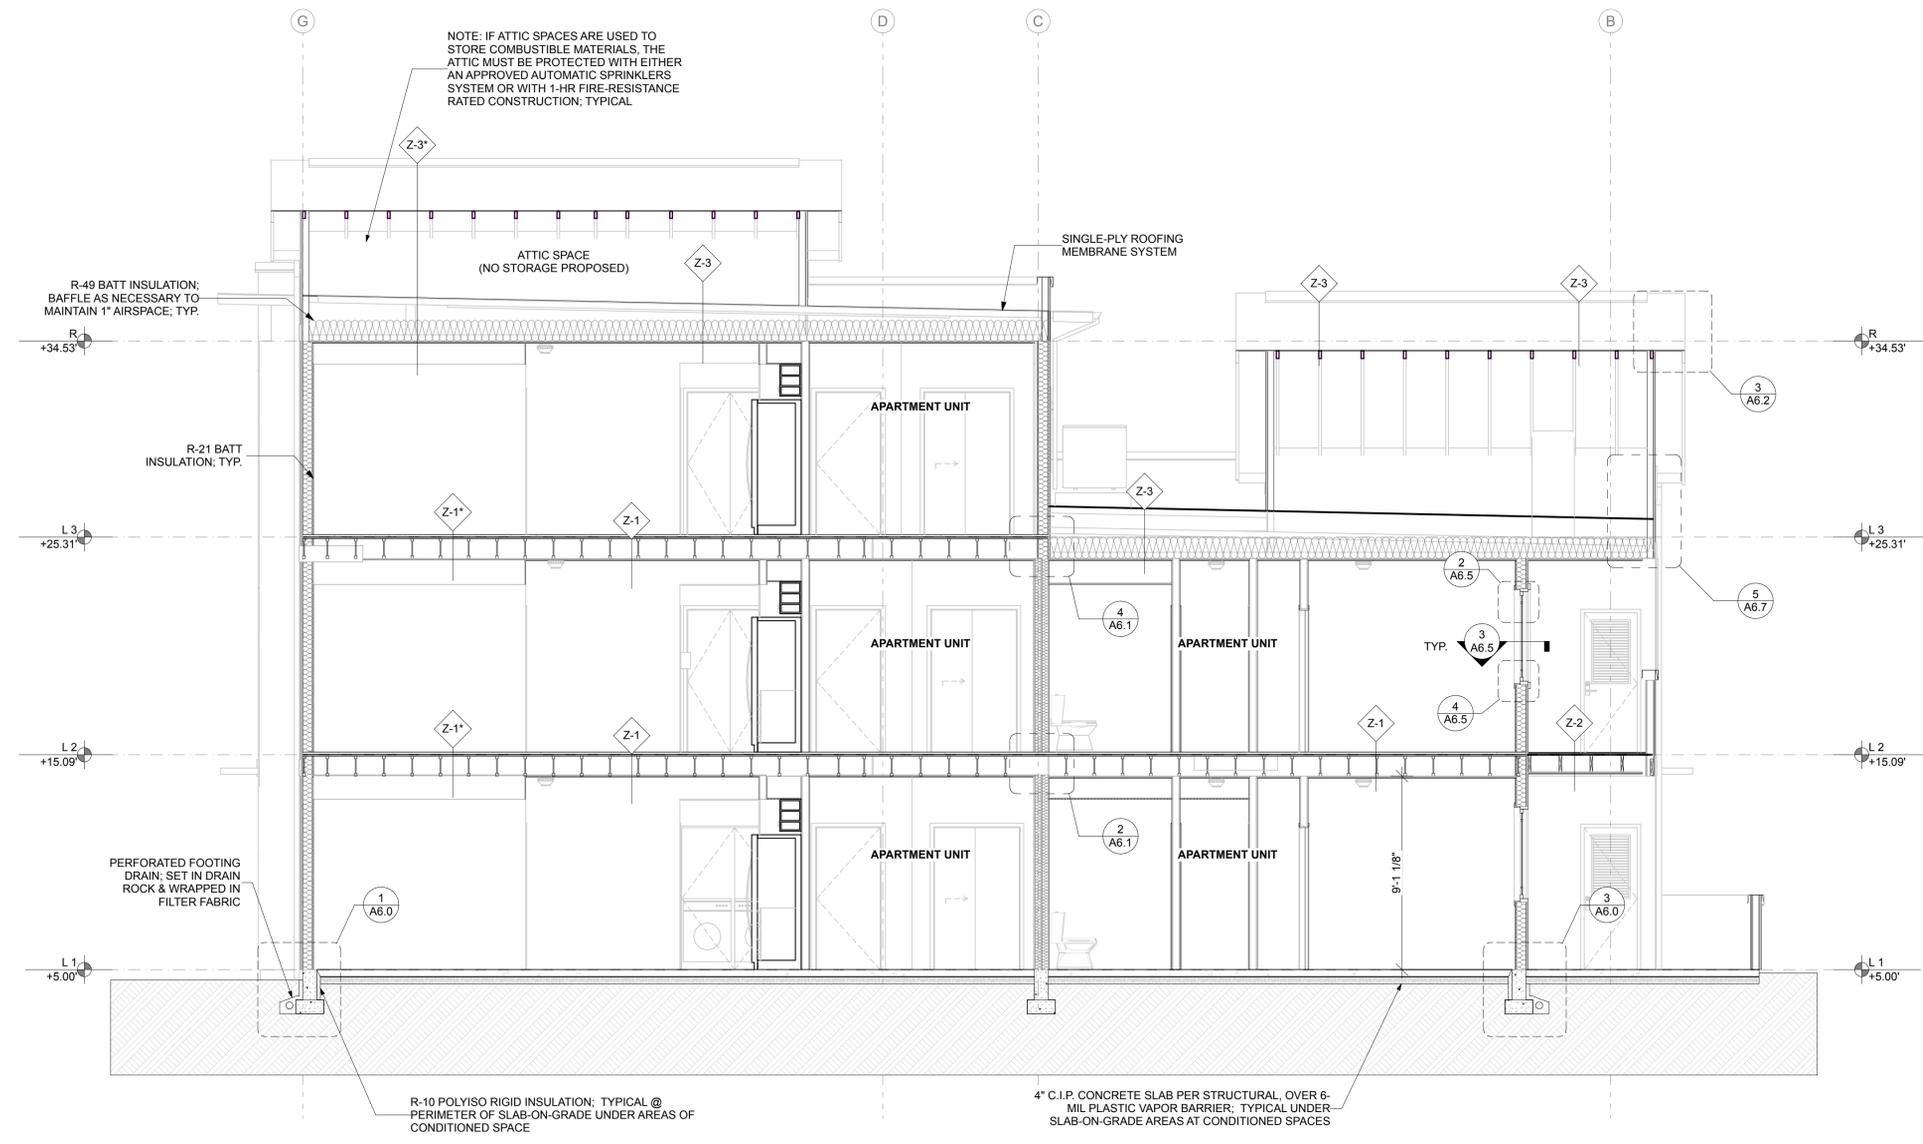

1 BUILDING SECTION 4
SCALE: 1/4" = 1'-0"

REVISIONS	
01	RESPONSE TO 1st REVIEW; 2025.08.05
02	RESPONSE TO 2nd REVIEW; 2025.07.31

REVISIONS	
DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	BUILDING SECTIONS
PROJECT #:	2016
SHEET:	

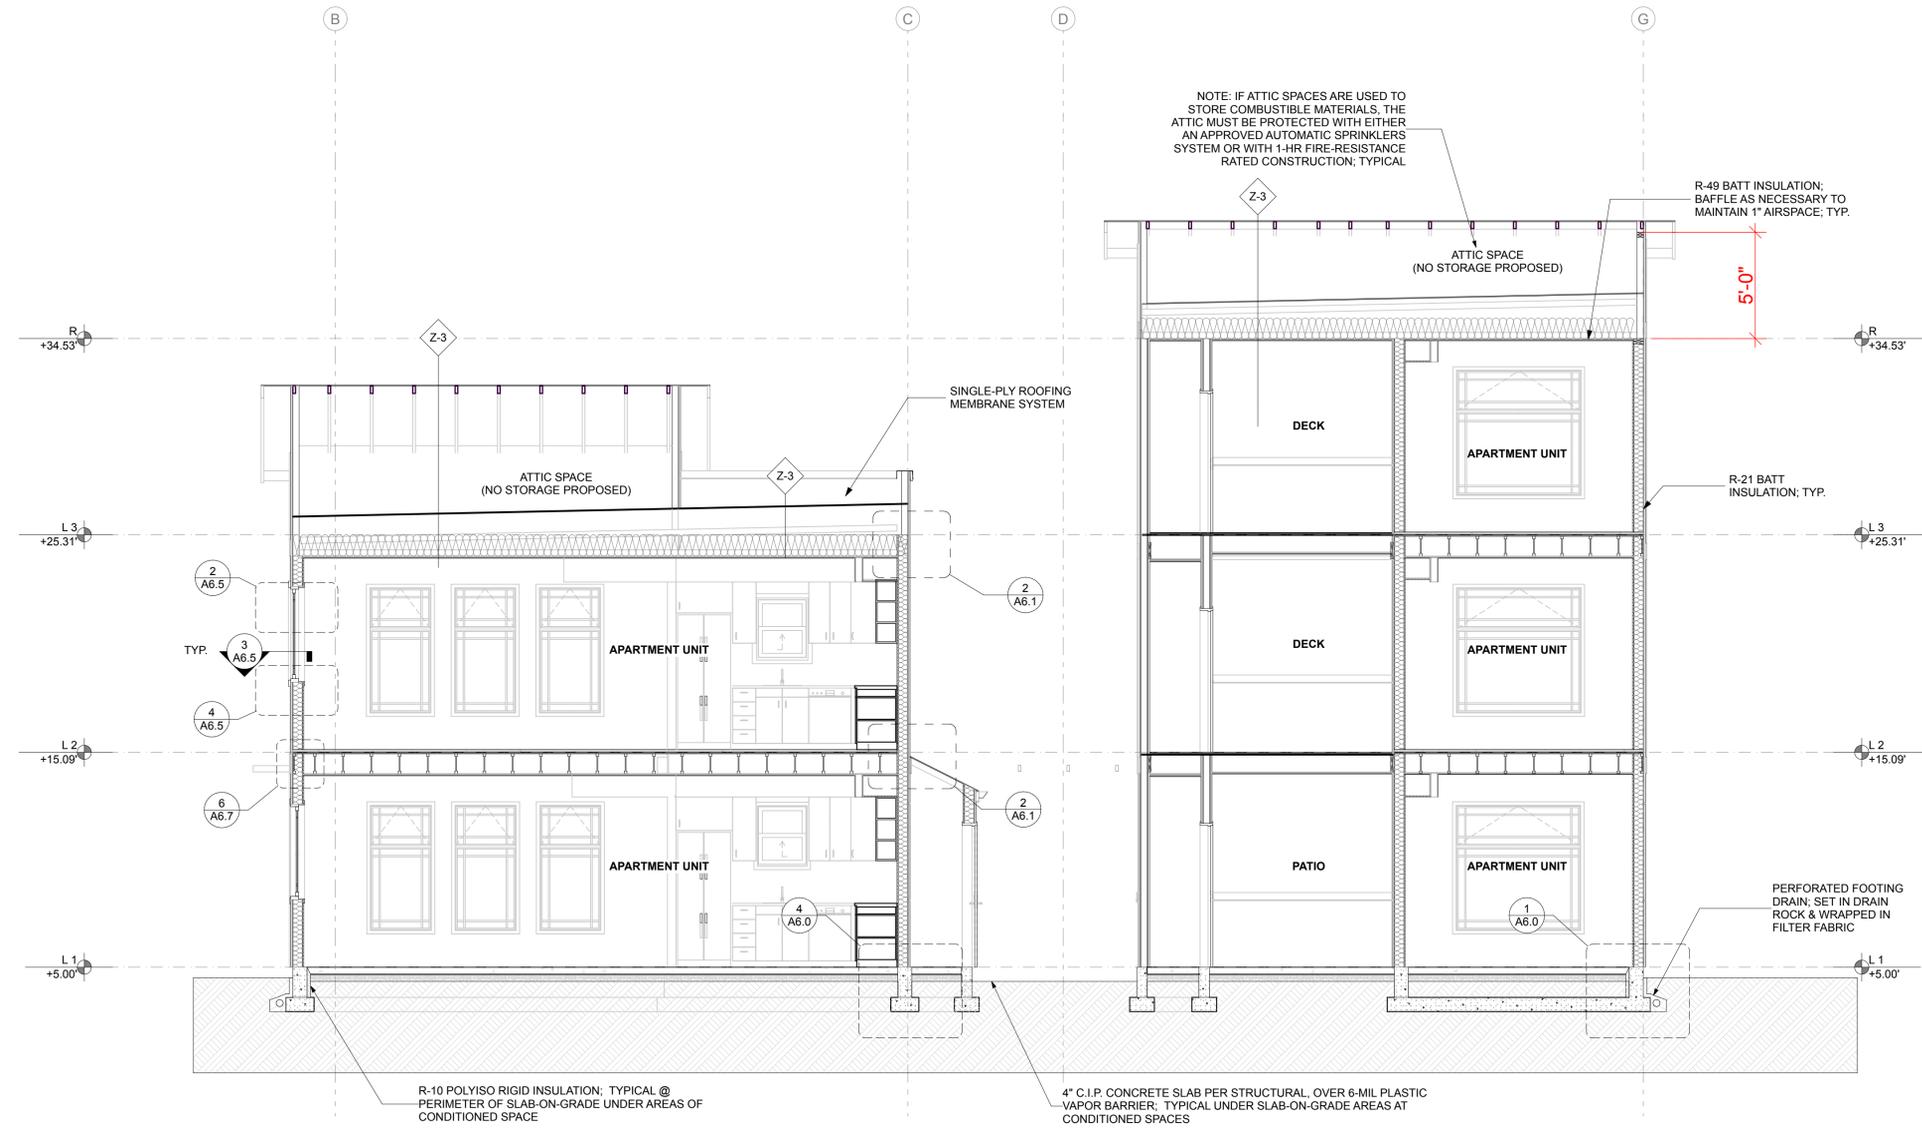


1 BUILDING SECTION 6
SCALE: 1/4" = 1'-0"

01

REVISIONS	
01	RESPONSE TO 1st REVIEW; 2025.08.05
02	RESPONSE TO 2nd REVIEW; 2025.07.31

REVISIONS

DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	BUILDING SECTIONS
PROJECT #:	2016
SHEET:	

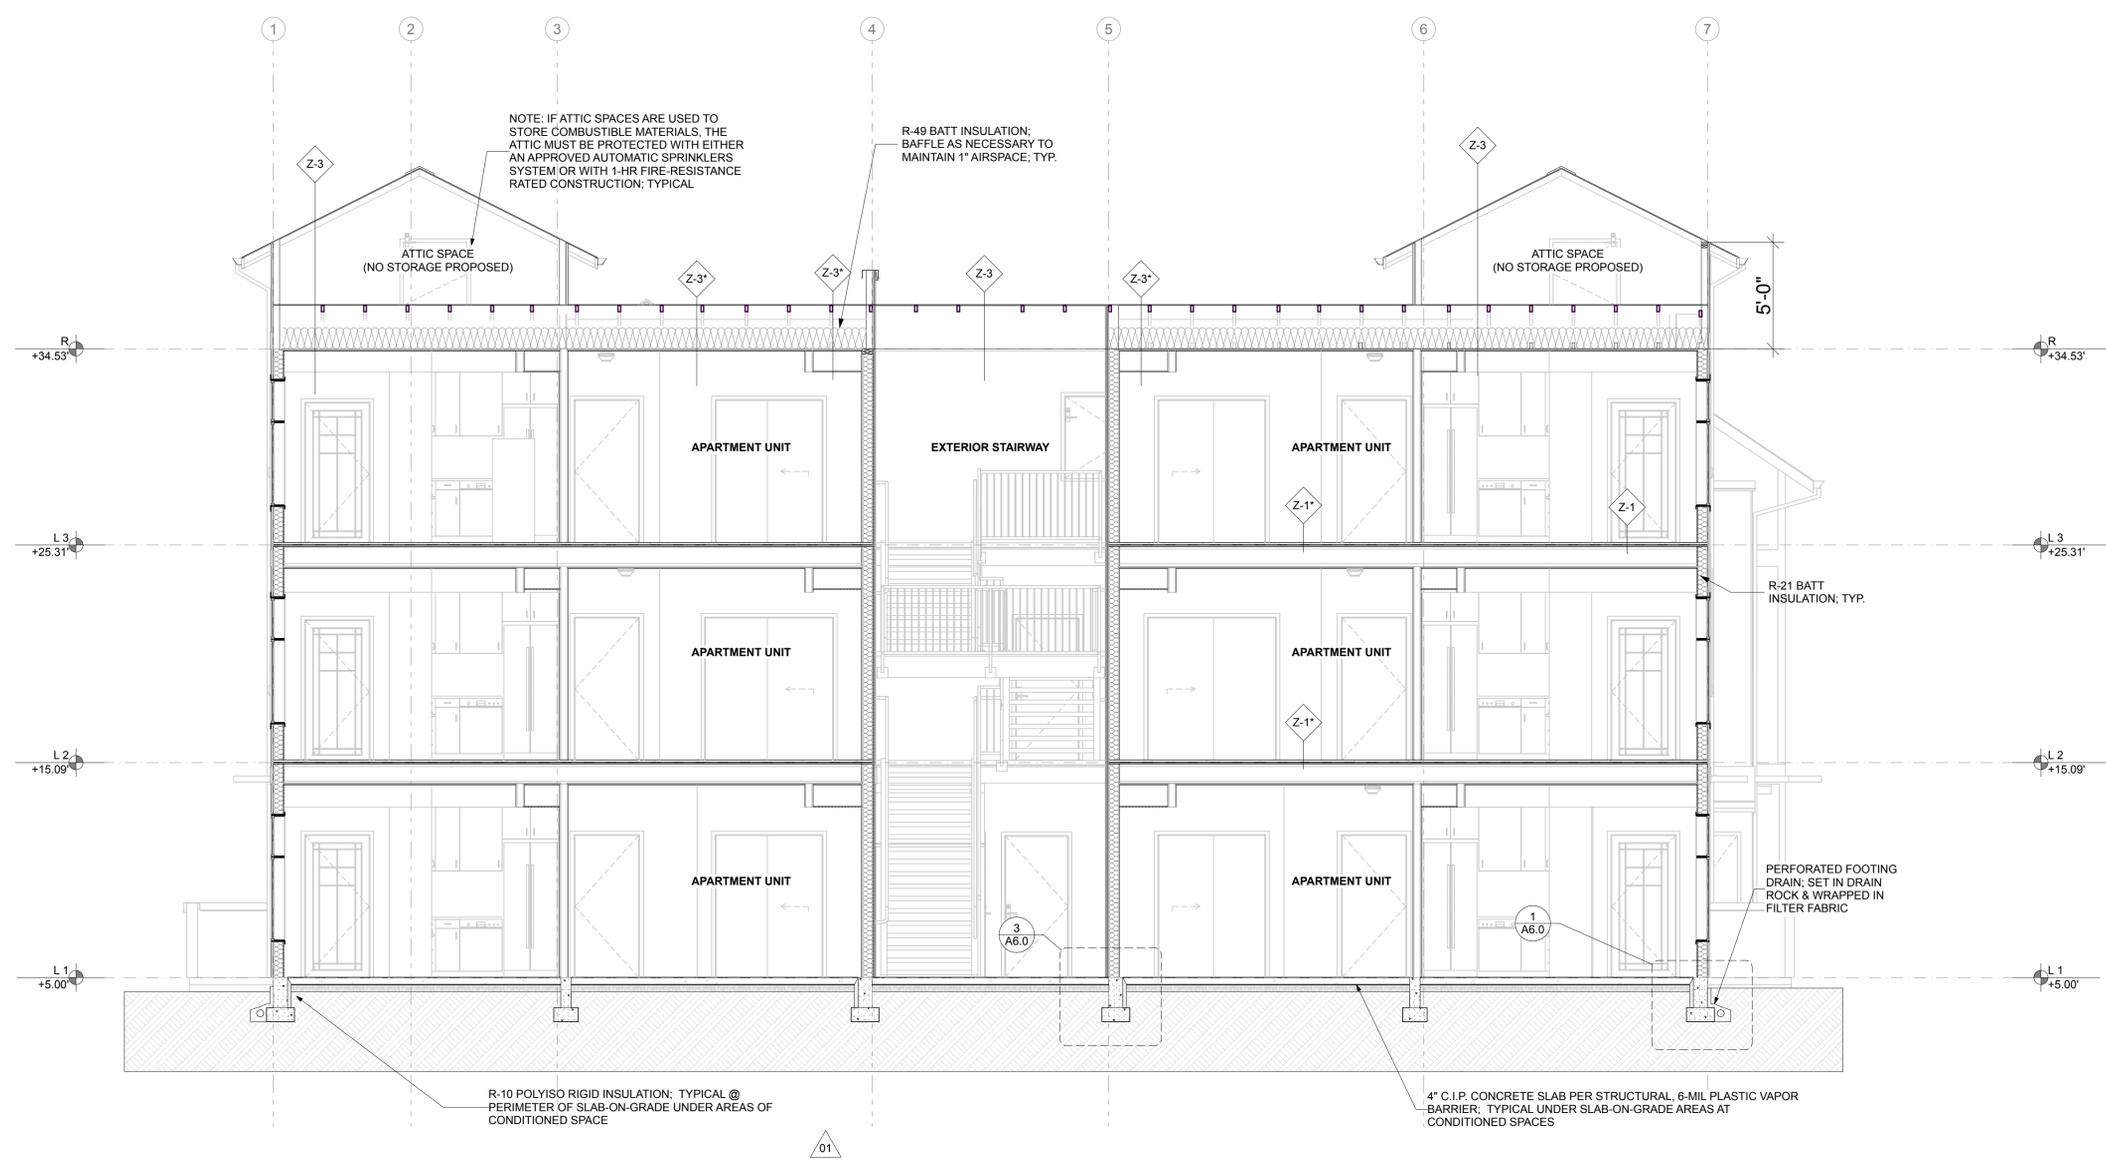

1 BUILDING SECTION 8
SCALE: 1/4" = 1'-0"

AGENCY REVIEW - REVISION No.2 | 25.08.29

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

REVISIONS	
DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	BUILDING SECTIONS
PROJECT #:	2016
SHEET:	

A3.7

EXTERIOR DOOR SCHEDULE

** SEE DOOR NOTES ON THIS SHEET 02

DOOR NUMBER	TYPE	ROOM	DOOR W x HT	NOTES
101A	A	UNIT 101	3'-0"×6'-8"	CLOSER; ACCESSIBLE THRESHOLD; 60-MINUTE RATED
101B	B	UNIT 101	3'-0"×6'-8"	
101C	C	UNIT 101 STORAGE	2'-6"×6'-8"	
102A	A	UNIT 102	3'-0"×6'-8"	CLOSER; ACCESSIBLE THRESHOLD; 60-MINUTE RATED
102B	B	UNIT 102	3'-0"×6'-8"	
102C	C	UNIT 102 STORAGE	2'-6"×6'-8"	
103A	A	UNIT 103	3'-0"×6'-8"	CLOSER; ACCESSIBLE THRESHOLD; 60-MINUTE RATED
103B	B	UNIT 103	3'-0"×6'-8"	
103C	C	UNIT 103 STORAGE	2'-6"×6'-8"	
104A	A	UNIT 104	3'-0"×6'-8"	CLOSER; ACCESSIBLE THRESHOLD; 60-MINUTE RATED
104B	B	UNIT 104	3'-0"×6'-8"	
104C	C	UNIT 104 STORAGE	2'-6"×6'-8"	
116A	J	RISER ROOM	2'-8"×6'-8"	CLOSER; ACCESSIBLE THRESHOLD; 60-MINUTE RATED
117A	J	RISER ROOM	2'-6"×6'-8"	CLOSER; ACCESSIBLE THRESHOLD; 60-MINUTE RATED
201A	A	UNIT 201	3'-0"×6'-8"	CLOSER; 60-MINUTE RATED
201B	B	UNIT 201	3'-0"×6'-8"	
201C	C	UNIT 201 STORAGE	2'-6"×6'-8"	
202A	A	UNIT 202	3'-0"×6'-8"	CLOSER; 60-MINUTE RATED
202B	B	UNIT 202	3'-0"×6'-8"	
202C	C	UNIT 202 STORAGE	2'-6"×6'-8"	
203A	A	UNIT 203	3'-0"×6'-8"	CLOSER; 60-MINUTE RATED
203B	B	UNIT 203	3'-0"×6'-8"	
203C	C	UNIT 203 STORAGE	2'-6"×6'-8"	
204A	A	UNIT 204	3'-0"×6'-8"	CLOSER; 60-MINUTE RATED
204B	B	UNIT 204	3'-0"×6'-8"	
204C	C	UNIT 104 STORAGE	2'-6"×6'-8"	
300A	J	ROOF ACCESS	3'-0"×4'-0"	CLOSER; 60-MINUTE RATED
301A	A	UNIT 301	3'-0"×6'-8"	CLOSER; 60-MINUTE RATED
301B	B	UNIT 301	3'-0"×6'-8"	
301C	C	UNIT 301 STORAGE	2'-6"×6'-8"	
304A	A	UNIT 304	3'-0"×6'-8"	CLOSER; 60-MINUTE RATED
304B	B	UNIT 304	3'-0"×6'-8"	
304C	C	UNIT 304 STORAGE	2'-6"×6'-8"	
RA			3'-0"×3'-0"	
RB			3'-0"×3'-0"	
RB	J	ROOF ACCESS	3'-0"×3'-0"	
RD	J	ROOF ACCESS	3'-0"×3'-0"	

WINDOW TYPES

ELEVATION	01	02	03	04
TYPE	01	02	03	04
SIZE (W x H)	2'-6"×3'-0"	6'-0"×6'-0"	6'-0"×4'-6"	2'-6"×3'-0"
QUANTITY	4	6	8	1
U-VALUE	0.30	0.30	0.30	
NOTES			EGRESS @ BEDROOMS	

ELEVATION	04	07	08
TYPE	04	07	08
SIZE (W x H)	2'-6"×3'-0"	5'-0"×4'-6"	3'-0"×6'-0"
QUANTITY	5	22	12
U-VALUE	0.30	0.30	0.30
NOTES		EGRESS @ BEDROOMS	

UNIT DOOR SCHEDULE

** SEE DOOR NOTES ON THIS SHEET 02

DOOR NUMBER	TYPE	ROOM	DOOR W x HT	NOTES
117A	H	BEDROOM	3'-0"×6'-8"	
117B	F	CLOSET	4'-0"×6'-8"	
117C	F	CLOSET	5'-0"×6'-8"	
117D	H	POWDER	2'-8"×6'-8"	PRIVACY LOCK
117E	H	BATHROOM	3'-0"×6'-8"	PRIVACY LOCK
117F	H	BEDROOM	3'-0"×6'-8"	
117G	F	CLOSET	5'-0"×6'-8"	
117H	E	LAUNDRY	5'-0"×6'-8"	
119A	E	CLOSET	3'-0"×6'-8"	
119B	H	BEDROOM	3'-0"×6'-8"	
119C	H	LAUNDRY	2'-6"×6'-8"	
119D	F	CLOSET	4'-0"×6'-8"	
119E	H	BEDROOM	3'-0"×6'-8"	
119F	F	CLOSET	4'-0"×6'-8"	
119G	H	BATHROOM	3'-0"×6'-8"	PRIVACY LOCK
119H	H	BATHROOM	3'-0"×6'-8"	PRIVACY LOCK
211A	E	CLOSET	4'-0"×6'-8"	
211B	H	BEDROOM	3'-0"×6'-8"	
211C	F	CLOSET	4'-0"×6'-8"	
211D	H	POWDER	2'-8"×6'-8"	PRIVACY LOCK
211E	H	BATHROOM	3'-0"×6'-8"	PRIVACY LOCK
211G	H	BEDROOM	3'-0"×6'-8"	
211H	F	CLOSET	6'-0"×6'-8"	
213F	E	LAUNDRY	4'-0"×6'-8"	
217A	E	CLOSET	3'-0"×6'-8"	
217B	H	BEDROOM	3'-0"×6'-8"	
217C	H	LAUNDRY	2'-6"×6'-8"	
217D	F	CLOSET	4'-0"×6'-8"	
217E	H	BEDROOM	3'-0"×6'-8"	
217F	F	CLOSET	4'-0"×6'-8"	
217G	H	BATHROOM	3'-0"×6'-8"	PRIVACY LOCK
217H	H	BATHROOM	3'-0"×6'-8"	PRIVACY LOCK
311A	H	BEDROOM	3'-0"×6'-8"	
311B	E	CLOSET	4'-0"×6'-8"	
311C	F	CLOSET	4'-0"×6'-8"	
311D	H	POWDER	2'-8"×6'-8"	PRIVACY LOCK
311E	H	BATHROOM	3'-0"×6'-8"	PRIVACY LOCK
311F	F	CLOSET	5'-0"×6'-8"	
311G	H	BEDROOM	3'-0"×6'-8"	
311H	E	LAUNDRY	4'-0"×6'-8"	

DOOR TYPES

ELEVATION	A	B	C	E	F	H	J	J
DOOR TYPE	A	B	C	E	F	H	J	J
FUNCTION	EXTERIOR SWINGING	EXTERIOR SWINGING	EXTERIOR SWINGING	INTERIOR SWINGING	SLIDING CLOSET	INTERIOR SWINGING		EXTERIOR SWINGING
PANEL	INSULATED HM DOOR	SAFETY GLAZED	HM DOOR	FLUSH HCW PANEL	FLUSH HCW PANEL	FLUSH HCW PANEL		INSULATED HM DOOR
FRAME	HM FRAME	HM FRAME	HM FRAME	WOOD FRAME	WOOD FRAME	WOOD FRAME		HM FRAME
NOTES	UNIT ENTRY	UNIT PATIO	UNIT STORAGE	(2) EQ. PANELS				

DOOR SCHEDULE NOTES

- DOOR OPERATIONS PER 1008.1.9 - EGRESS DOORS SHALL BE READILY OPENABLE FROM THE EGRESS SIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT.
- DOOR HARDWARE PER 1008.1.9.1 - DOOR HANDLES, PULLS, LATCHES, LOCKS AND OTHER OPERATING DEVICES ON DOORS REQUIRED TO BE ACCESSIBLE BY CHAPTER 11 SHALL NOT REQUIRE TIGHT GRASPING, TIGHT PINCHING OR TWISTING OF THE WRIST TO OPERATE.
- HARDWARE HEIGHT PER 1008.1.9.2 - DOOR HANDLES, PULLS, LATCHES, LOCKS AND OTHER OPERATING DEVICES SHALL BE INSTALLED 34 INCHES MINIMUM AND 48 INCHES MAXIMUM ABOVE THE FINISHED FLOOR. LOCKS USED ONLY FOR SECURITY PURPOSES AND NOT USED FOR NORMAL OPERATION ARE PERMITTED AT ANY HEIGHT.
- ACCESSIBLE, FOR TYPE-A AND TYPE-B THRESHOLDS PER ICC A117.1-2009 SECTION 303 - THRESHOLDS AT DOORWAYS SHALL BE 1/2" MAXIMUM IN HEIGHT.
- DOOR CLOSERS PER ICC A117.1-2009 - DOOR CLOSERS SHALL BE ADJUSTED SO THAT FROM AN OPEN POSITION OF 90 DEGREES, THE TIME REQUIRED TO MOVE THROUGH THE DOOR TO AN OPEN POSITION OF 12 DEGREES SHALL BE 5 SECONDS.
- DOOR-OPENING FORCE PER ICC A117.1-2009 - THE FORCE FOR PUSHING OR PULLING OPEN DOORS SHALL BE 10.0 POUNDS MAXIMUM PER WASHINGTON STATE AMMENDMENT.

DOOR HARDWARE LOCKSETS and DEFINITIONS

SECURITY LOCKSET - THE LATCHBOLT IS RETRACTED BY THE GRIP ON EITHER SIDE UNLESS THE OUTSIDE GRIP IS LOCKED BY THE OUTSIDE KEY. OPERATING THE INSIDE GRIP ALWAYS RETRACTS THE LATCHBOLT.

ACCESSIBLE SECURITY LOCKSET - THE LATCHBOLT IS RETRACTED BY THE GRIP ON EITHER SIDE UNLESS THE OUTSIDE GRIP IS LOCKED BY EITHER THE INSIDE KEY OR THE OUTSIDE KEY. OPERATING THE INSIDE GRIP ALWAYS RETRACTS THE LATCHBOLT. ALL COMPONENTS OF THE DOOR HARDWARE TO MEET ACCESSIBILITY REQUIREMENTS OF SECTION 1008.1.9 OF THE 2018 IBC.

OFFICE LOCKSET - THE LATCHBOLT IS RETRACTED BY THE GRIP ON EITHER SIDE UNLESS THE OUTSIDE GRIP IS LOCKED BY THE TOGGLE OR OUTSIDE KEY. OPERATING THE INSIDE GRIP DOES NOT UNLOCK THE OUTSIDE GRIP.

PASSAGE LOCKSET - THE LATCHBOLT IS ALWAYS RETRACTED BY THE GRIP ON EITHER SIDE. BOTH GRIPS ARE ALWAYS FREE.

PRIVACY LOCKSET - THE LATCHBOLT IS RETRACTED BY THE GRIP ON EITHER SIDE UNLESS THE OUTSIDE GRIP IS LOCKED BY THE INSIDE THUMB-TURN, BUTTON OR KEY. OPERATING THE INSIDE GRIP UNLOCKS THE OUTSIDE GRIP. AN EMERGENCY RELEASE TOOL UNLOCKS THE OUTSIDE GRIP. THE OUTSIDE GRIP IS ALSO UNLOCKED WHEN THE DOOR IS CLOSED. DOOR CAN ONLY BE LOCKED FROM THE INSIDE WHEN THE DOOR IS CLOSED.

PUBLIC RESTROOM LOCKSET - THE LATCHBOLT IS RETRACTED BY THE INSIDE GRIP OR AN OUTSIDE KEY. THE LATCHBOLT IS RETRACTED BY THE OUTSIDE GRIP UNLESS THE GRIP IS LOCKED BY A KEY FROM THE INSIDE. THE LATCHBOLT / OUTSIDE GRIP CANNOT BE LOCKED BY A KEY FROM THE OUTSIDE. ALL COMPONENTS OF THE DOOR HARDWARE GROUP TO MEET ACCESSIBILITY REQUIREMENTS OF SECTION 1008.1.9 OF THE 2018 IBC.

STOREROOM LOCKSET - THE LATCHBOLT IS RETRACTED BY THE INSIDE GRIP OR OUTSIDE KEY.

CLOSET LOCKSET - THE LATCHBOLT IS RETRACTED BY THE OUTSIDE AND THE INSIDE GRIP AND THE GRIP CANNOT BE LOCKED.

GLAZING NOTES

- GLAZING IN A FIXED AND OPERABLE PANELS OF SWINGING, SLIDING AND BIFOLD DOORS SHALL BE CONSIDERED HAZARDOUS LOCATIONS.
- GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE OF THE GLAZING IS WITHIN A 24-INCH ARC OF EITHER VERTICAL EDGE OF THE DOOR IN A CLOSED POSITION AND WHERE THE BOTTOM EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE THE WALKING SURFACE SHALL BE CONSIDERED A HAZARDOUS LOCATION.
- GLAZING IN INDIVIDUAL FIXED OR OPERABLE PANEL OF A WINDOW THAT MEETS ALL OF THE FOLLOWING FOUR CONDITIONS SHALL BE CONSIDERED A HAZARDOUS LOCATION: 1. THE EXPOSED AREA OF AN INDIVIDUAL PANEL IS GREATER THAN 10 SQUARE FEET. 2. THE BOTTOM EDGE OF THE GLAZING IS LESS THAN 18 INCHES ABOVE THE FLOOR. 3. THE TOP EDGE OF THE GLAZING IS GREATER THAN 36 INCHES ABOVE THE FLOOR; AND 4. ONE OR MORE WALKING SURFACE(S) ARE WITHIN 36 INCHES, MEASURED HORIZONTALLY AND IN A STRAIGHT LINE, OF THE PLANE OF THE GLAZING.



SYNTHESIS 9, LLC
521A D ST
TACOMA, WA 98403

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE DESIGNATIONS INCORPORATED HEREIN AS INSTRUMENTS OF PROFESSIONAL SERVICE ARE THE PROPERTY OF SYNTHESIS 9, LLC AND ARE NOT TO BE USED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN AUTHORIZATION OF SYNTHESIS 9, LLC.



PRGA20250487



EAST TOWN CROSSING
BUILDING 'A'
3002 E PIONEER WAY PUYALLUP WA 98372

REVISIONS

01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

AGENCY REVIEW - REVISION No.2 | 25.08.29

REVISIONS


DRAWN BY: BL / CM
CHECKED BY: BL
DATE: 25.08.29
TITLE: DOORS & WINDOWS
PROJECT #: 2016
SHEET:

A4.0


REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31
REVISIONS	
DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	INTERIOR ELEVATIONS
PROJECT #:	2016
SHEET:	

DWELLING UNIT ACCESSIBILITY NOTES:


1. THE ACCESSIBLE PRIMARY ENTRANCE SHALL BE ON AN ACCESSIBLE ROUTE FROM PUBLIC AND COMMON AREAS. WITHIN THE UNIT, AT LEAST ONE ACCESSIBLE ROUTE SHALL CONNECT ALL SPACES AND ELEMENTS. THE ACCESSIBLE ROUTE SHALL HAVE A CLEAR WIDTH OF AT LEAST 36-INCHES, EXCEPT THAT SEGMENTS LESS THAN 24-INCHES IN LENGTH MAY HAVE A CLEAR WIDTH OF 32-INCHES.
2. IN THE TYPE 'A' UNIT, TURNING SPACES SHALL BE REQUIRED IN ALL ROOMS. TURNING SPACE SHALL BE 60-INCH IN DIAMETER.
3. THE CORRIDOR SIDE OF THE PRIMARY ENTRANCE DOOR TO TYPE 'B' UNITS SHALL HAVE MANEUVERING CLEARANCES COMPLYING WITH ANSI 404, ICC A117.1.
4. IN TYPE 'A' UNITS, ALL DOORWAYS INTENDED FOR PASSAGE SHALL HAVE MANEUVERING CLEARANCES COMPLYING WITH ANSI 404, ICC A117.1.
5. CHANGES IN LEVEL OF 1/4-INCH OR LESS ARE PERMITTED TO BE VERTICAL. CHANGES IN LEVEL BETWEEN 1/4-INCH AND 1/2-INCH SHALL BE BEVELED WITH A SLOPE OF 1:2. THRESHOLDS SHALL NOT BE GREATER THAN 1/2-INCH, EXCEPT THAT THEY MAY BE 3/4-INCH AT EXTERIOR SLIDING DOORS.
6. IN TYPE 'A' UNITS, LIGHTING CONTROLS, ELECTRICAL SWITCHES AND RECEPTACLE OUTLETS, ENVIRONMENTAL CONTROLS, APPLIANCE CONTROLS, OPERATING HARDWARE FOR OPERABLE WINDOWS, PLUMBING FIXTURE CONTROLS, AND USER CONTROLS FOR SECURITY OR INTERCOM SYSTEMS SHALL BE PROVIDED WITH A CLEAR FLOOR SPACE AND BE PLACED WITHIN ONE OF THE REACH RANGES SPECIFIED IN SECTION 308, ICC A117.1. THEY SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING OR TWISTING OF THE WRIST. THE MAXIMUM FORCE REQUIRED TO ACTIVATE THE PARTS SHALL BE 5-POUNDS.
7. IN TYPE 'B' UNITS, LIGHTING CONTROLS, ELECTRICAL SWITCHES AND RECEPTACLE OUTLETS, ENVIRONMENTAL CONTROLS, APPLIANCE CONTROLS, OPERATING HARDWARE FOR OPERABLE WINDOWS, PLUMBING FIXTURE CONTROLS, AND USER CONTROLS FOR SECURITY OR INTERCOM SYSTEMS SHALL BE PROVIDED WITH A CLEAR FLOOR SPACE AND SHALL BE PLACED WITHIN ONE OF THE REACH RANGES SPECIFIED IN ANSI 308, ICC 117.1.
8. "CLEAR FLOOR SPACE" IS 30-INCHES BY 48-INCHES PER ANSI 305.3. BATHROOMS AND KITCHENS REQUIRE CLEAR FLOOR SPACES, CLEARANCES AROUND, BETWEEN AND ADJACENT TO FIXTURES, APPLIANCES, CABINETS, COUNTERS AND WALLS, AND OTHER ITEMS SHOWN IN THE DRAWINGS.
9. OPERABLE PARTS SHALL BE PLACED BETWEEN 15-INCHES AND 48-INCHES ABOVE THE FLOOR IN AN AREA WITH UNOBSTRUCTED FORWARD OR SIDE REACH. WHEN THERE IS AN OBSTRUCTION OF 24-INCHES MAXIMUM WIDTH AND 34-INCHES MAXIMUM HEIGHT, THE OPERABLE PARTS SHALL BE NO HIGHER THAN 46-INCHES ABOVE THE FLOOR. WHEN THERE IS AN OBSTRUCTION OF 25-INCHES MAXIMUM WIDTH IN A SPACE ALLOWING FORWARD APPROACH, THE OPERABLE PARTS SHALL BE NO HIGHER THAN 44-INCHES ABOVE THE FLOOR PER ANSI 308, ICC A117.1.
10. IN TYPE 'A' UNITS, WASHING MACHINES AND CLOTHES DRYERS REQUIRE A CLEAR FLOOR SPACE, POSITIONED FOR PARALLEL APPROACH, CENTERED ON EACH APPLIANCE. ALL OPERABLE PARTS SHALL COMPLY WITH SECTION 309, ICC A117.1, INCLUDING THE REACH RANGES SPECIFIED IN ANSI 308, ICC 117.1. TOP LOADING MACHINES SHALL HAVE THE DOOR TO THE LAUNDRY COMPARTMENT 36-INCHES MAXIMUM ABOVE THE FLOOR. FRONT LOADING MACHINES SHALL HAVE THE BOTTOM OF THE OPENING TO THE LAUNDRY COMPARTMENT BETWEEN 15-INCHES AND 34-INCHES ABOVE THE FLOOR.
11. IN TYPE 'B' UNITS, WASHING MACHINES AND CLOTHES DRYERS REQUIRE A CLEAR FLOOR SPACE, POSITIONED FOR PARALLEL APPROACH, CENTERED ON EACH APPLIANCE.
12. IN TYPE 'B' UNITS, WASHING MACHINES AND CLOTHES DRYERS REQUIRE A CLEAR FLOOR SPACE, POSITIONED FOR PARALLEL APPROACH, CENTERED ON EACH APPLIANCE.
13. CABINERY IS PERMITTED UNDER WORK SURFACES & SINK WHEN THE CABINERY CAN BE REMOVED WITHOUT THE REMOVAL OR REPLACEMENT OF WORK SURFACE OR SINK, FLOOR FINISH EXTENDS UNDER CABINERY AND WALLS BEHIND AND SURROUNDING CABINERY ARE FINISHED.
14. TYPE 'B' UNIT BATHROOMS ARE OPTION 'B'.

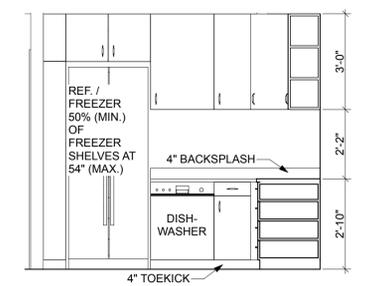


3 UNIT 101 KITCHEN
SCALE: 3/8" = 1'-0"
ADA TYPE 'A'

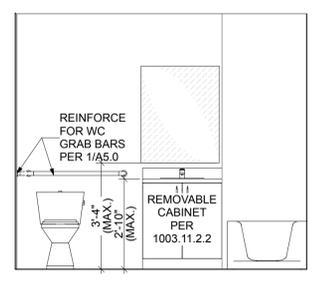


2 UNIT 101 BATH
SCALE: 3/8" = 1'-0"
ADA TYPE 'A'

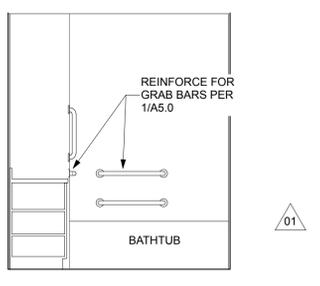


1 UNIT 101 BATH
SCALE: 3/8" = 1'-0"
ADA TYPE 'A'

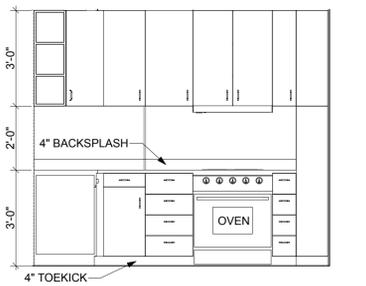


6 UNIT 102 KITCHEN
SCALE: 3/8" = 1'-0"
ADA TYPE 'A'

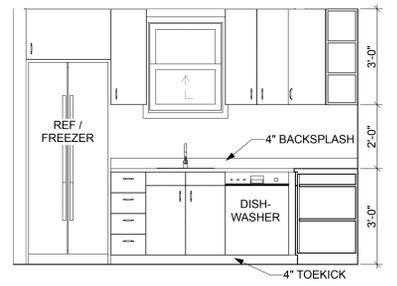


5 UNIT 102 KITCHEN
SCALE: 3/8" = 1'-0"
ADA TYPE 'B'

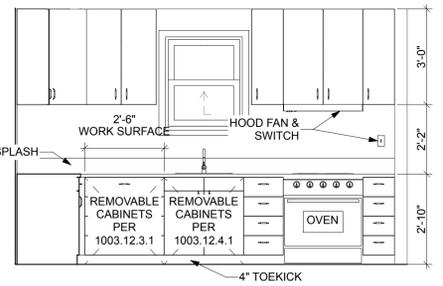



4 UNIT 101 KITCHEN
SCALE: 3/8" = 1'-0"
ADA TYPE 'A'








8 UNIT 102 BATH
SCALE: 3/8" = 1'-0"
ADA TYPE 'B'

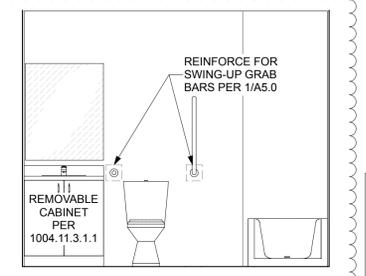

7 UNIT 102 BATH
SCALE: 3/8" = 1'-0"
ADA TYPE 'B'

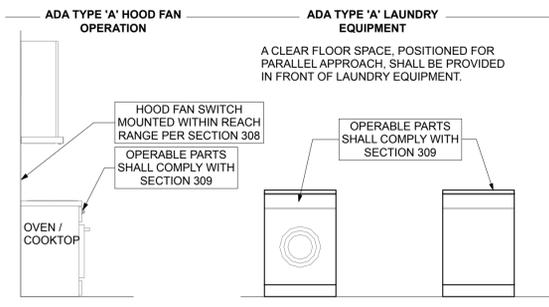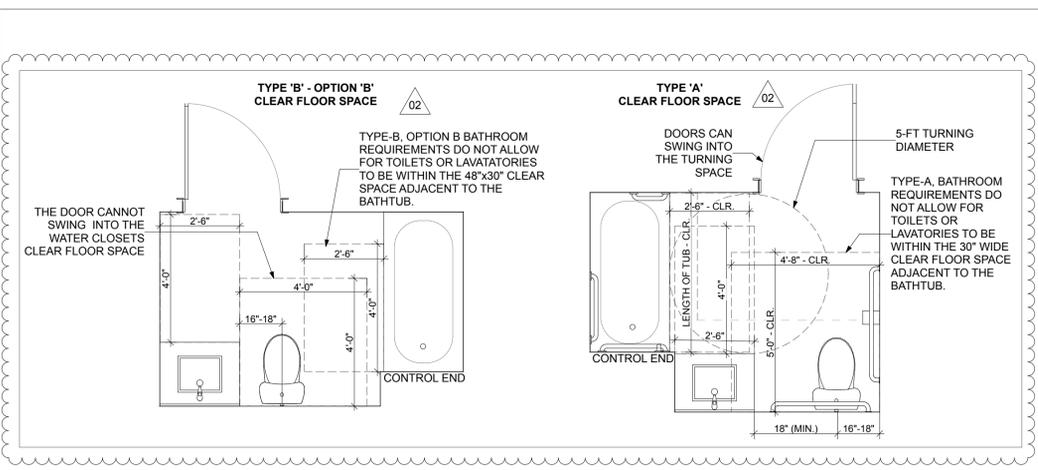


- TYPICAL TYPES 'A' AND 'B' BATHROOM NOTES:**
1. GRAB BARS ARE NOT REQUIRED TO BE INSTALLED WHERE REINFORCEMENT IS PROVIDED FOR THE FUTURE INSTALLATION OF GRAB BARS & SHOWER SEATS AT WATER CLOSETS, BATHTUBS AND SHOWERS PER ICC/ANSI A117.1-2009, 1003.11.1 AND 1004.11.1.
 2. DIMENSIONS AT GRAB BAR LOCATIONS ARE TO CENTERLINE OF REQUIRED GRAB BARS; ADD AN ADDITIONAL 2-INCHES MINIMUM AT TOP, SIDES AND BOTTOM FOR BLOCKING SIZES.
 3. CABINERY IS PERMITTED UNDER WORK SURFACES & SINK WHEN THE CABINERY CAN BE REMOVED WITHOUT THE REMOVAL OR REPLACEMENT OF WORK SURFACE OR SINK. FLOOR FINISH EXTENDS UNDER CABINERY AND WALLS BEHIND AND SURROUNDING CABINERY ARE FINISHED.
 4. WHEN BASE CABINETS ARE TO BE REMOVED AT LOWERED WORK SURFACES AND SINKS, KNEE AND TOE CLEARANCES SHALL BE PROVIDED.
 5. IN TYPE 'B' UNITS, REINFORCEMENT FOR A 24" REAR WALL GRAB BAR, CENTERED ON THE FIXTURE, AT WATER CLOSETS WHEN THERE IS INSUFFICIENT WALL SPACE FOR THE 36" GRAB BAR.
 6. IN TYPE 'B' UNITS, REINFORCEMENT FOR A SWING UP GRAB BAR PER ANSI A117.1 1004.11.1.1 WHERE A SIDE WALL IS NOT AVAILABLE FOR A 42-INCH GRAB BAR.
 7. IN TYPE 'B' UNITS, REINFORCEMENT FOR A VERTICAL GRAB BAR AT WATER CLOSETS IS NOT REQUIRED.

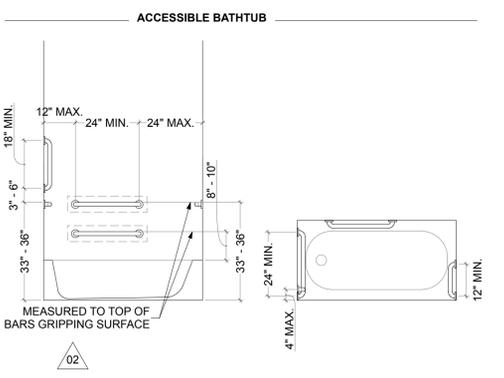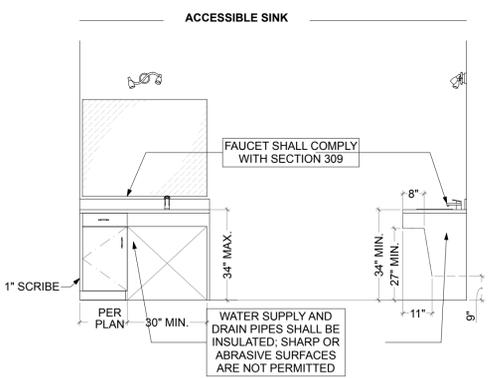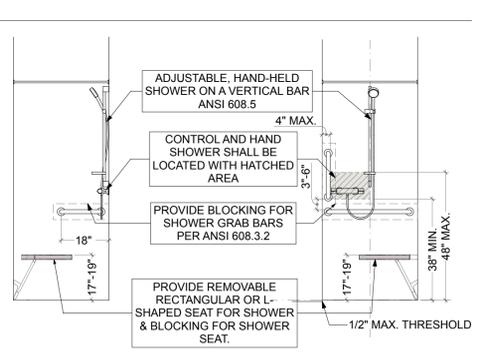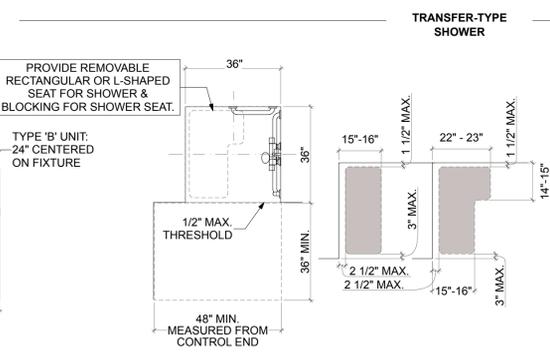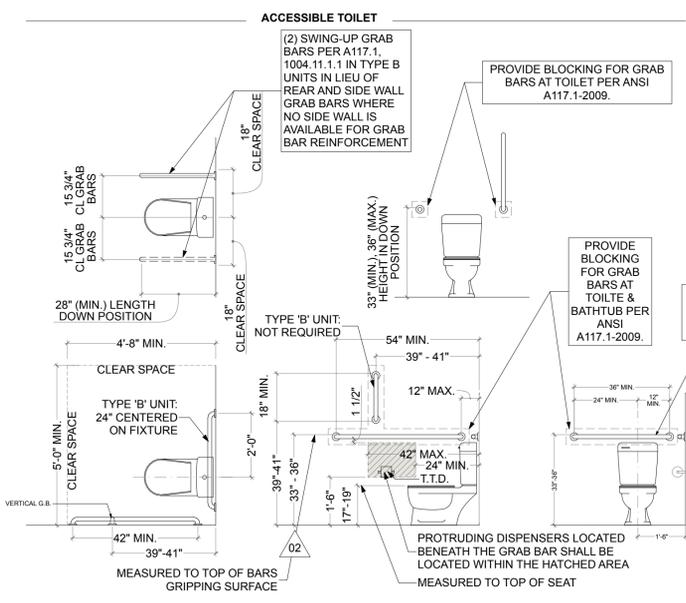


9 TYPE A & B BATHROOM FIXTURES & APPLIANCES
SCALE: 3/8" = 1'-0"

FOUNDATION DETAIL REFERENCE NOTES


- 01 WALL PER PLAN
- 02 VAPOR PERMEABLE AIR BARRIER / W.R.B. FIELD MEMBRANE
- 03 CONTINUOUS, SELF-ADHERED MEMBRANE (S.A.M.) ALONG TOP EDGE OF METAL FLASHING
- 04 BELOW GRADE WATER-PROOFING SYSTEM W/ DRAINAGE MAT AND FILTER FABRIC PROTECTION LAYER
- 05 22 GAUGE, SHEET METAL FLASHING, W/ HEMMED EDGE; SET ON SEALANT & EXTEND 6" UP UNDER W.R.B. OR TO WINDOW OPENING
- 06 FILTER FABRIC OVER MINIMUM 1/2-INCH DRAINAGE MATRIX
- 07 METAL LATHE WITH BOND & SCRATCH COAT
- 08 NOT USED
- 09 6 MIL PLASTIC VAPOR BARRIER
- 10 NOT USED
- 11 R-10 POLYISO INSULATION, CONFIGURED AS SHOWN TO TOP OF FOOTING OR 2-FT IN LENGTH
- 12 NOT USED
- 13 CEMENT FIBERBOARD PANEL OR LAP-SIDING SIDING - HARDIE PANEL OR APPROVED SUBSTITUTE
- 14 NOT USED
- 15 NOT USED
- 16 ANCHOR BOLT & TREATED SILL PLATE(S) PER STRUCTURAL
- 17 CONCRETE & REINFORCING PER STRUCTURAL (TYPICAL)
- 18 12-INCH WIDE GRACE VYCOR SILL PAN / FLASHING W/ END DAMS; AT EACH SILL CORNER, INSTALL VYCORNERS AND CORNER PATCHES PER THE MFR'S RECOMMENDATIONS; WRAP UP THE STEEL ANGLE TO CREATE A DAM.
- 19 CONT. BACK DAM ANGLE, MIN. 1-INCH TALL WITH VINYL ASSEMBLY FASTENED THROUGH ANGLE PER MFR. RECOMMENDATIONS.
- 20 4" PERF. FOOTING DRAIN AND 4" TIGHT-LINE DRAIN; SET IN DRAIN ROCK AND WRAP IN FILTER FABRIC; SEE CIVIL DRAWINGS FOR RELATED INFORMATION
- 21 3/8" SEALANT JOINT WITH BACKER ROD.
- 22 PRIMED COUNTER-FLASHING ABOVE TRIM; PROVIDE 1/4-INCH PER FOOT SLOPE TO HEMMED EDGE
- 23 GALV. METAL SILL PAN AT ANY DOOR WITH A THRESHOLD
- 24 VINYL WINDOW FRAME W/ FLANGE
- 25 PRIMED COUNTER-FLASHING ABOVE TRIM; PROVIDE 1/4-INCH PER FOOT SLOPE TO HEMMED EDGE
- 26 INSTALL PLASTIC HORSESHOE SHIMS @ EACH SILL FLANGE FASTENER
- 27 1/4-INCH WITH CAULK (ONE PART URETHANE SEALANT)
- 28 VYCOR-PLUS BY GRACE AT MUD SILL W/ 1/4-INCH DOWNTURN ON EXTERIOR SIDE WHEN FEASIBLE

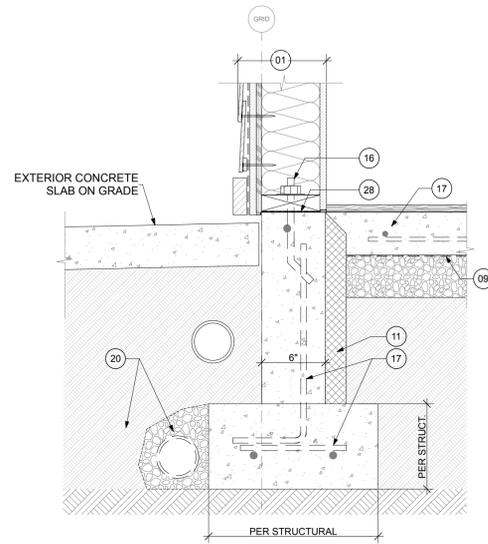


3 FOUNDATION DETAIL - 03
SCALE: 1 1/2" = 1'-0"

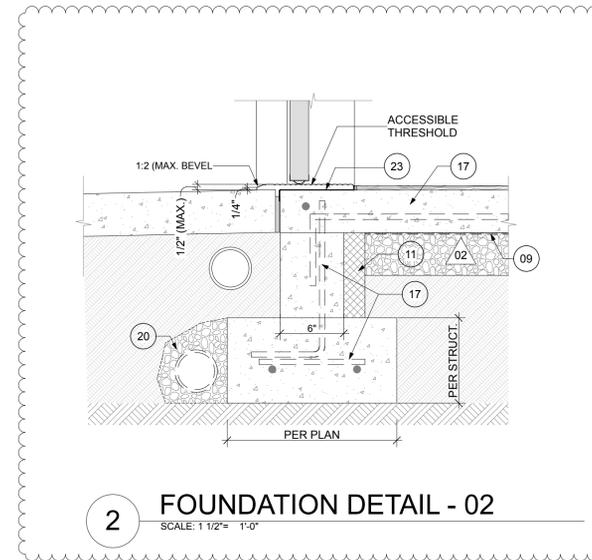


2 FOUNDATION DETAIL - 02
SCALE: 1 1/2" = 1'-0"

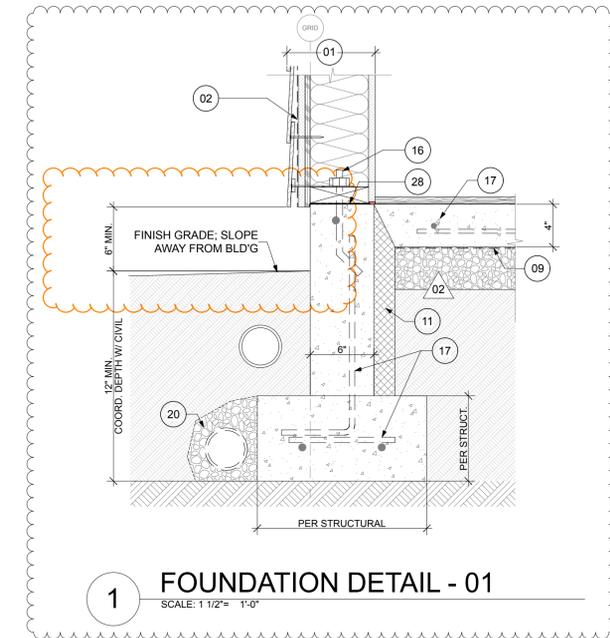


1 FOUNDATION DETAIL - 01
SCALE: 1 1/2" = 1'-0"

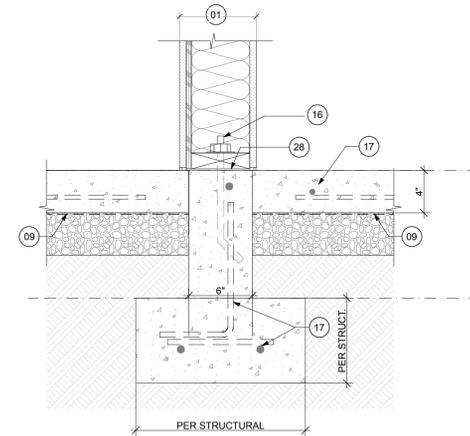

6 FOUNDATION DETAIL - 06
SCALE: 1 1/2" = 1'-0"

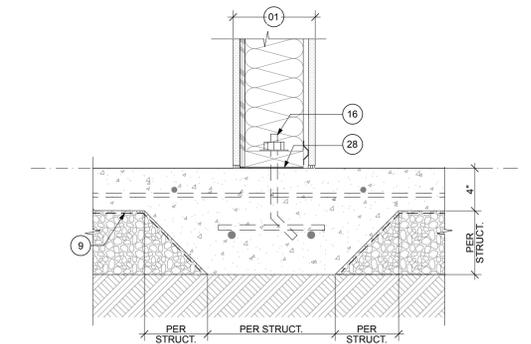

5 FOUNDATION DETAIL - 05
SCALE: 1 1/2" = 1'-0"

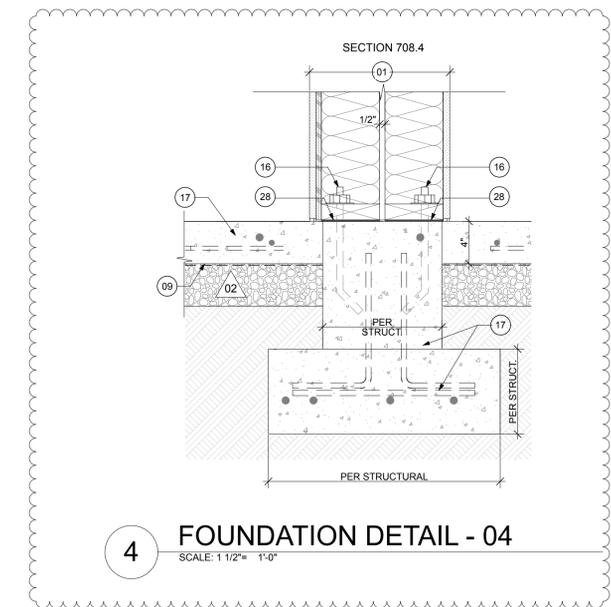

4 FOUNDATION DETAIL - 04
SCALE: 1 1/2" = 1'-0"



SYNTHESIS 9, LLC
521 N. D ST.
TACOMA, WA 98403

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE DESIGNATIONS INCORPORATED HEREIN AS INSTRUMENTS OF PROFESSIONAL SERVICE ARE THE PROPERTY OF SYNTHESIS 9, LLC AND ARE NOT TO BE USED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN AUTHORIZATION OF SYNTHESIS 9, LLC.

REGISTERED ARCHITECT
9251
BRAD WALKER
BRETT TALLEY LINDSAY
STATE OF WASHINGTON

PRGA20250487

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building Planning
Engineering Public Works
Fire Traffic

EAST TOWN CROSSING
BUILDING 'A'
3002 E PIONEER WAY PUYALLUP WA 98372

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31


DRAWN BY: BL / CM
CHECKED BY: BL
DATE: 25.08.29
TITLE: DETAILS
PROJECT #: 2016
SHEET:

A6.0

AGENCY REVIEW - REVISION No.2 | 25.08.29

DETAIL REFERENCE NOTES


- 01 WALL PER PLAN
- 02 VAPOR PERMEABLE AIR BARRIER / WATER RESISTANT BARRIER FIELD MEMBRANE
- 03 AIR BARRIER / WATER RESISTANT BARRIER PRESTRIP WITH CONTINUOUS A.B. / W.R.B. SEALANT BETWEEN FIELD MEMBRANE (AS SHOWN)
- 04 FLOOR / CEILING ASSEMBLY PER PLAN
- 05 PRE-FINISHED ALUMINUM OR VINYL, CONTINUOUS STRIP VENT. SEE REFLECTED CEILING PLANS FOR LOCATIONS AND LENGTHS
- 06 1-1/4" x 5-1/2" CEMENT FIBERBOARD TRIM AROUND OPENING - HARDIE TRIM OR APPROVED SUBSTITUTE
- 07 NOT USED
- 08 VINYL WINDOW OR SLIDING DOOR FRAME WITHOUT FLANGE AND ON 1/4-INCH INTERMITTENT SHIMS FOR DRAINAGE.
- 09 CEMENT FIBERBOARD CLADDING PER ELEVATIONS; LAP W/ 7-1/4" EXPOSURE OR PANEL WITH REVEAL ACCESSORIES - HARDIE PLANK OR APPROVED SUBSTITUTE
- 10 NOT USED
- 11 CORRUGATED, PRE-FINISHED METAL SIDING; EXPOSED FASTENERS WITH NEOPRENE GASKETS; NU-WAVE BY AEPPSPAN
- 12 NOT USED
- 13 FLEXIBLE, SELF-ADHERED A.B. / W.R.B. SILL MEMBRANE; PER INSTALLATION INSTRUCTIONS ON SHEET A6.4.
- 14 CONT. BACK DAM ANGLE, MIN. 1-INCH TALL WITH VINYL ASSEMBLY FASTENED THROUGH ANGLE PER MFR. RECOMMENDATIONS.
- 15 ONE PART URETHANE SEALANT OVER BACKER ROD; FOAM BACKER ROD W/ BOND BREAKER JACKET - OVERSIZE ROD 25% LARGER THAN WIDTH OF JOINT; CLEAN SUBSTRATE USING A "TWO CLOTH" METHOD PER SEALANT MANUFACTURER - PRIME PER MFR ONLY WHERE REQUIRED.
- 16 CONTINUOUS AIR BARRIER SEALANT OVER BACKER ROD (WHEN SHOWN) TIED TO CONTINUOUS SEAL AT WINDOW PERIMETER.
- 17 1/4-INCH WITH PAINTABLE CAULK
- 18 NOT USED
- 19 NOT USED
- 20 PRIMED COUNTER-FLASHING ACCESSORY ABOVE TRIM or RIP SLOPE IN TOP OF TRIM AND 1/4-INCH CAULK AT JOINT; PROVIDE 1/4-INCH PER FOOT SLOPE.
- 21 PRE-FINISHED SHEET METAL SILL FLASHING W/ 1/2-INCH HEMMED DRIP EDGE WITH END DAMNS INTO BED JOINT AT JAMB VENEER TRIM BEYOND
- 22 PRIMED SHEET METAL HEAD FLASHING W/ 1/2" HEMMED DRIP EDGE & END DAMNS. EXTEND 6-INCHES MINIMUM UP UNDER THE A.B. / W.R.B. AND OVERLAP JAMB TRIM
- 23 PRE-FINISHED SHEET METAL JAMB FLASHING TRIM
- 24 EXTRUDED ALUMINUM HORIZONTAL TRIM ACCESSORY (BY EXTREMETRIM OR APPROVED); PAINT PER MFR'S RECOMMENDATIONS; APPROXIMATE CONFIGURATION AS SHOWN.
- 25 5 x 5 x 5/16" x 5" TALL GALV. STEEL ANGLE CLIP; (2) AT EACH SIDE OF GUARDRAIL ASSEMBLY; NOTE THAT THE ATTACHMENT TO THE WALL STRUCTURE SHALL BE CONCEALED BEHIND CLADDING.
- 26 1/4" THICK NEOPRENE PAD BETWEEN VERTICAL ALUMINUM GUARDRAIL POST AND GALV. STEEL CLIP
- 27 PRE-FINISHED ALUMINUM GUARDRAIL ASSEMBLY; FACE-MOUNT ATTACHMENT PER STRUCTURAL
- 28 FLEXIBLE, SELF-ADHERED A.B. / W.R.B. MEMBRANE; USE 12-INCH WIDE GRACE VYCOR SILL PANFLASHING W/ END DAMNS. WRAP UP SIDEWALL 4" MIN. ABOVE TOP OF FINISH FLOOR

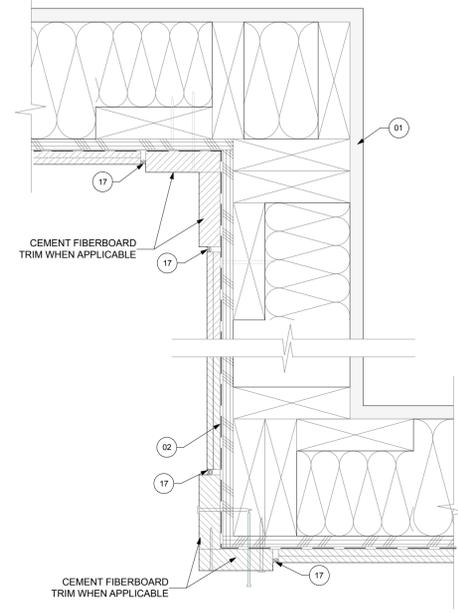


3 SIDING TRANSITION DETAIL
SCALE: 3" = 1'-0"

6 ROOF ACCESS DETAIL
SCALE: 1 1/2" = 1'-0"


NOT USED

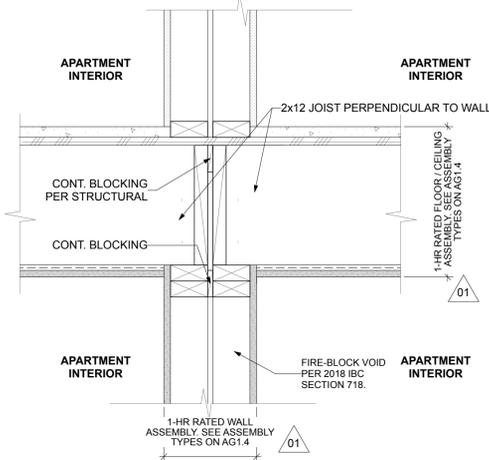

2 FLOOR-CEILING ASSEMBLY CONTINUITY
SCALE: 1 1/2" = 1'-0"

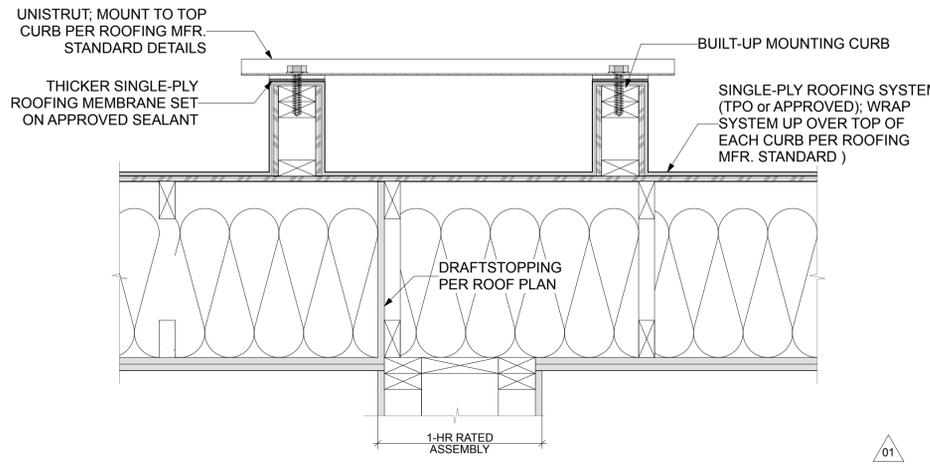


5 ROOFTOP EQUIPMENT MOUNT CURB
SCALE: 1 1/2" = 1'-0"

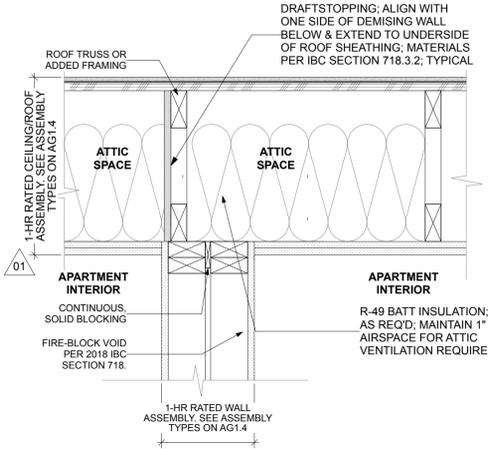



DRAFTSTOPPING PARALLEL TO FRAMING

1 TYPICAL DRAFT STOP
SCALE: 1 1/2" = 1'-0"

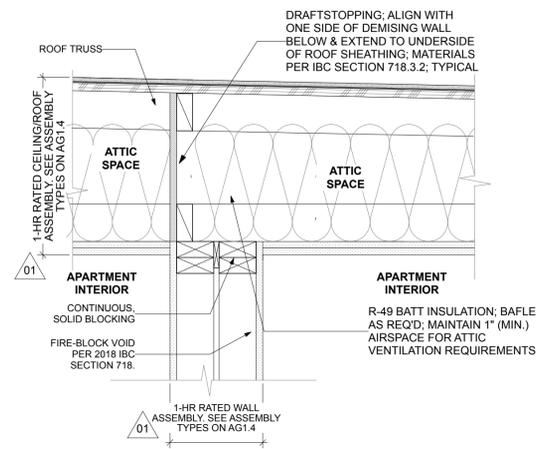

DRAFTSTOPPING PERPENDICULAR TO FRAMING

4 FIRE RATING CONTINUITY
SCALE: 1 1/2" = 1'-0"

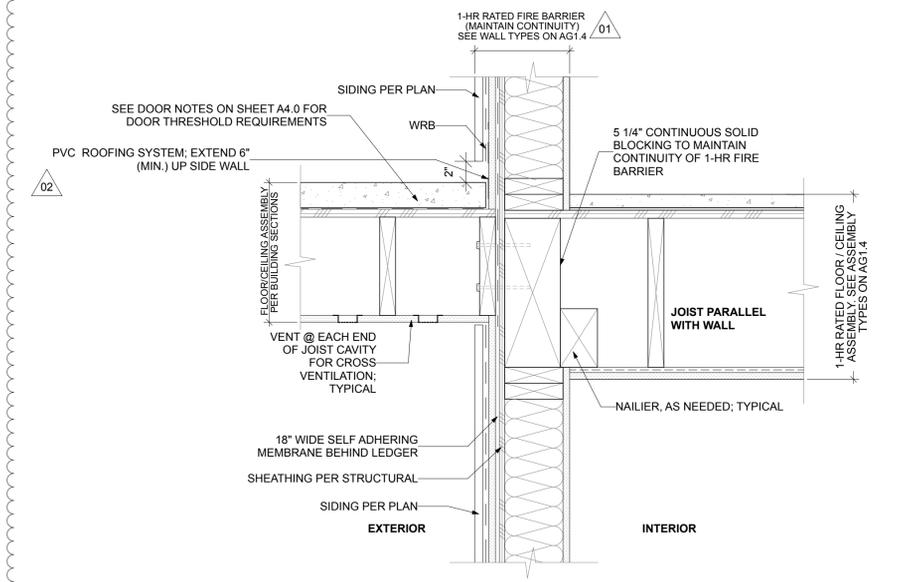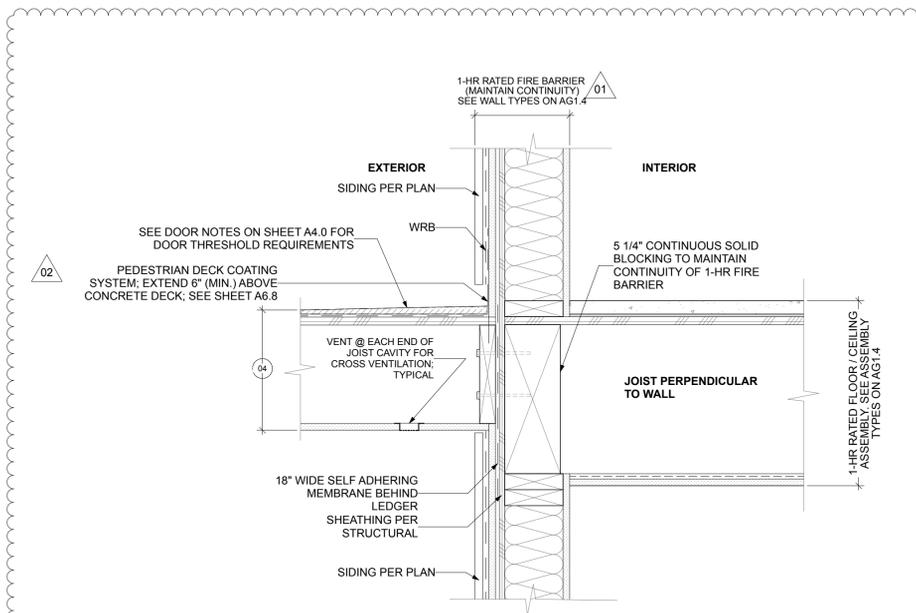


REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

AGENCY REVIEW - REVISION No.2 | 25.08.29


REVISIONS	
DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	DETAILS
PROJECT #:	2016
SHEET:	

ROOF | CEILING DETAIL REFERENCE NOTES


- 01 WALL PER PLAN; COORDINATE FIRE RATING & SHEAR WALL REQUIREMENTS WITH CODE REQUIREMENTS AS NOTED ON SHEET A0.01
- 02 W.R.B. (TYVEK OR APPROVED SUBSTITUTE)
- 03 CONTINUOUS, SELF-ADHERED MEMBRANE (S.A.M.) ALONG TOP EDGE OF METAL FLASHING
- 04 NOT USED
- 05 ROOF FASCIA - 1.5" X 5.5" CEMENT FIBERBOARD TRIM
- 06 ROOF FASCIA - 1.5" X 7.25" CEMENT FIBERBOARD TRIM
- 07 2" ϕ SCREENED VENTING AT BLOCKING; (3) PER TRUSS BAY (MIN.) FOR VENTILATION
- 08 PRIMED-TO-BE-PAINTED, ALUMINUM GUTTER & DOWNSPOUT
- 09 22 GAUGE, SHEET METAL EDGE FLASHING, W/ HEMMED EDGE; AT EAVE, EXTEND UP UNDER ROOFING UNDERLAYMENT 6" MINIMUM; AT RAKE OVERLAP THE ROOFING UNDERLAYMENT 4" MINIMUM.
- 10 ASPHALT SHINGLE ROOFING OVER ROOFING UNDERLAYMENT
- 11 MAINTAIN 1" MINIMUM AIRSPACE
- 12 1/4-INCH WITH CAULK (ONE PART URETHANE SEALANT)
- 13 CEMENT FIBERBOARD PANEL OR LAP-SIDING SIDING - HARDIE PANEL OR APPROVED SUBSTITUTE
- 14 NOT USED
- 15 2" ϕ SCREENED VENTING AT 8" O.C.
- 16 3/8" SEALANT JOINT WITH BACKER ROD.
- 17 PRE-FINISHED ALUMINUM OR VINYL, CONTINUOUS STRIP VENT; SEE REFLECTED CEILING PLANS FOR LOCATIONS AND LENGTHS
- 18 PRE-FINISHED, SIDEWALL SHEET METAL FLASHING; EXTEND 6" MINIMUM UP UNDER W.R.B.
- 19 BAFFLED SIDEWALL VENT W/ 9 sq. in. PER LINEAR FOOT VENTILATION OR BAFFLED RIDGE VENT W/ 18 sq. in. PER LINEAR FOOT VENTILATION

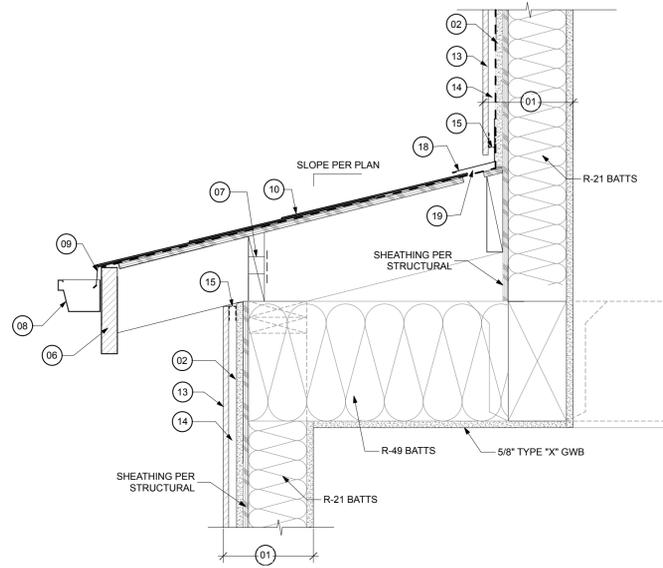


8 ROOF DETAIL - 08
SCALE: 1 1/2" = 1'-0"

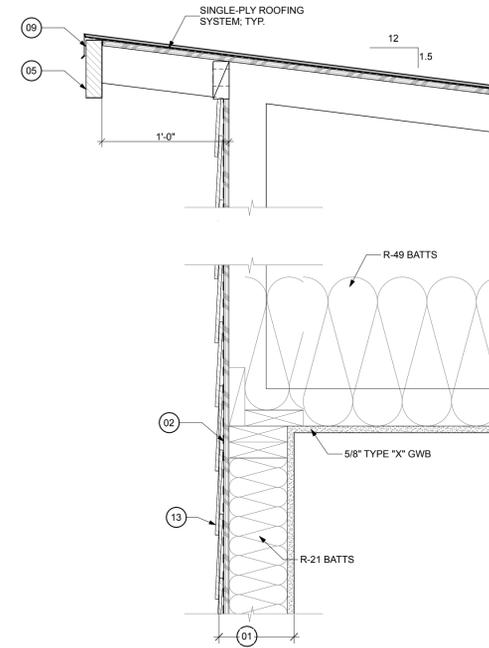


2 ROOF DETAIL - 02
SCALE: 1 1/2" = 1'-0"

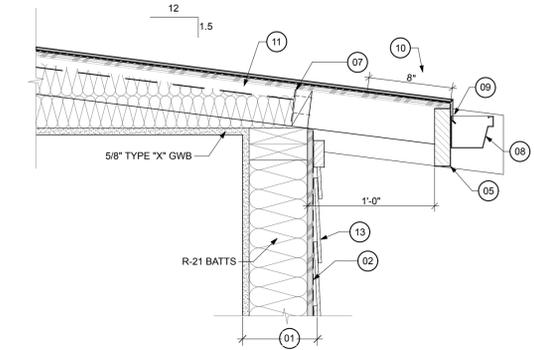


1 ROOF DETAIL - 01
SCALE: 1 1/2" = 1'-0"

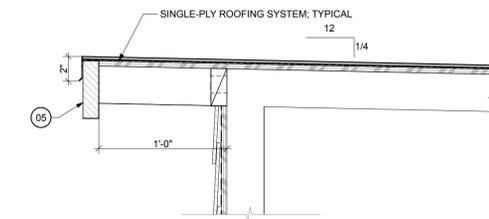


4 ROOF DETAIL - 04
SCALE: 1 1/2" = 1'-0"

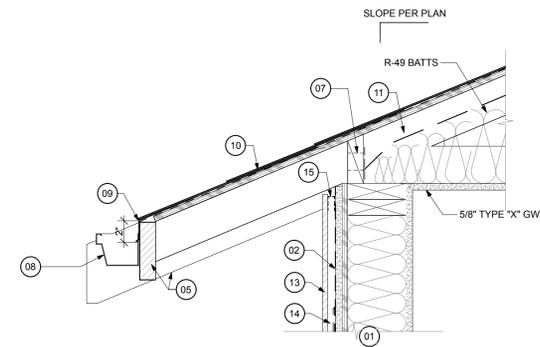


7 ROOF DETAIL - 07
SCALE: 1 1/2" = 1'-0"

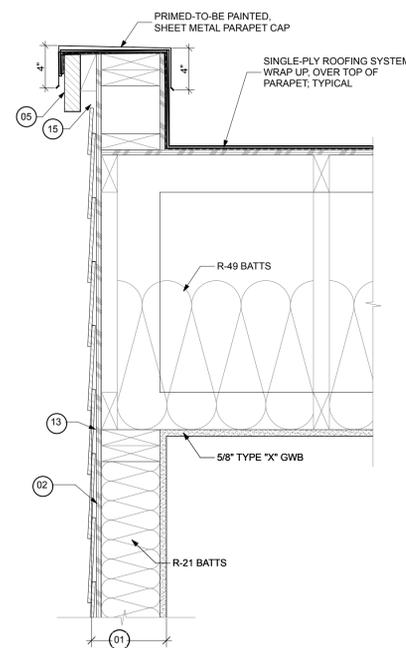

6 ROOF DETAIL - 06
SCALE: 1 1/2" = 1'-0"

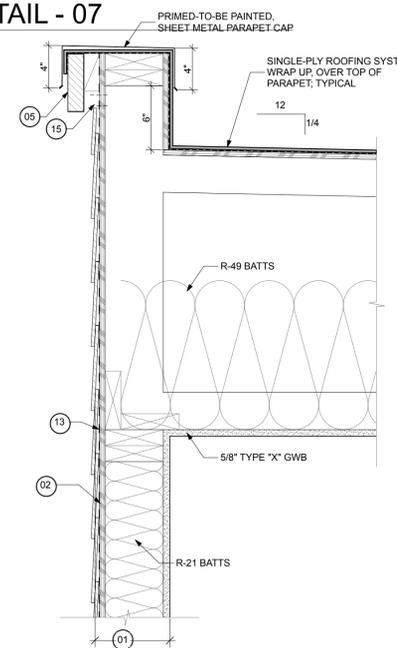

5 ROOF DETAIL - 05
SCALE: 1 1/2" = 1'-0"

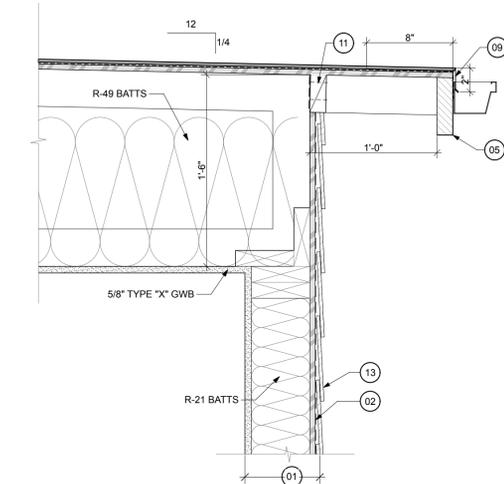

3 ROOF DETAIL - 03
SCALE: 1 1/2" = 1'-0"



SYNTHESIS 9, LLC
621 N. D ST
TACOMA, WA 98403

REUSE OF DOCUMENTS
INCORPORATED HEREIN AS PERMITS OF
PROFESSIONAL SERVICE ARE THE PROPERTY OF
SYNTHESIS 9, LLC AND ARE NOT TO BE USED OR
REPRODUCED IN WHOLE OR IN PART WITHOUT THE
WRITTEN AUTHORIZATION OF SYNTHESIS 9, LLC.



PRGA20250487





EAST TOWN CROSSING
BUILDING 'A'
3002 E PIONEER WAY PUYALLUP WA 98372

REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

AGENCY REVIEW - REVISION No.2 | 25.08.29




REVISIONS	
DRAWN BY:	BL / CM
CHECKED BY:	BL
DATE:	25.08.29
TITLE:	DETAILS
PROJECT #:	2016
SHEET:	

A6.2

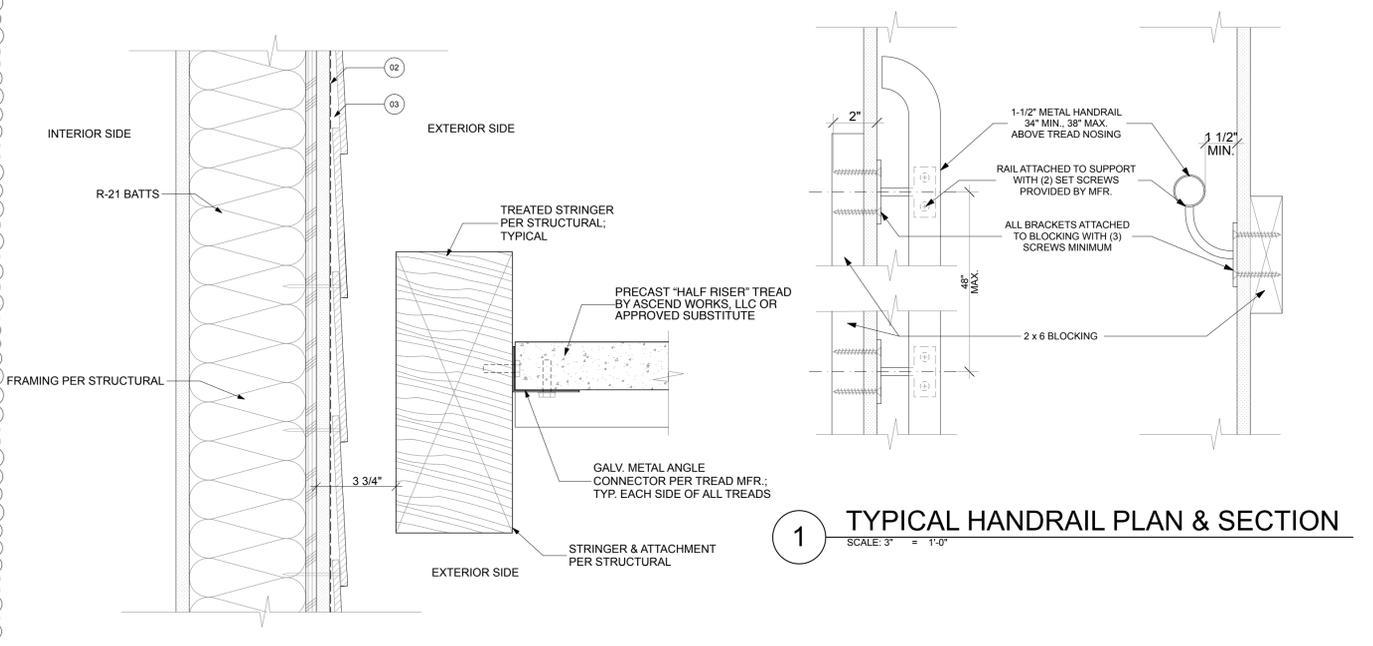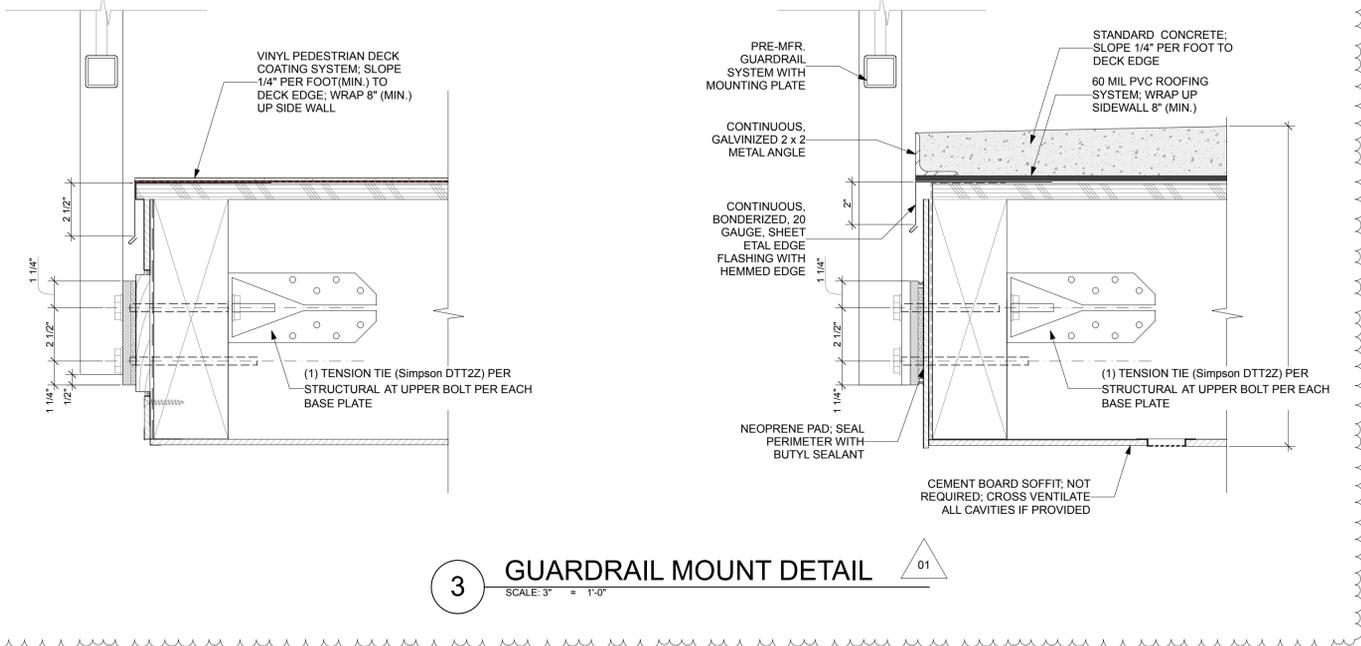

DETAIL REFERENCE NOTES

- 01 WALL PER PLAN
- 02 VAPOR PERMEABLE AIR BARRIER / WATER RESISTANT BARRIER FIELD MEMBRANE
- 03 AIR BARRIER / WATER RESISTANT BARRIER PRESTRIP WITH CONTINUOUS A.B. / W.R.B. SEALANT BETWEEN FIELD MEMBRANE (AS SHOWN)
- 04 FLOOR / CEILING ASSEMBLY PER PLAN
- 05 PRE-FINISHED ALUMINUM OR VINYL CONTINUOUS STRIP VENT; SEE REFLECTED CEILING PLANS FOR LOCATIONS AND LENGTHS
- 06 1-1/4" x 5-1/2" CEMENT FIBERBOARD TRIM AROUND OPENING - HARDIE TRIM OR APPROVED SUBSTITUTE
- 07 NOT USED
- 08 VINYL WINDOW OR SLIDING DOOR FRAME WITHOUT FLANGE AND ON 1/4-INCH INTERMITTENT SHIMS FOR DRAINAGE
- 09 CEMENT FIBERBOARD CLADDING PER ELEVATIONS; LAP W/ 7-1/4" EXPOSURE OR PANEL WITH REVEAL ACCESSORIES - HARDIE PLANK OR APPROVED SUBSTITUTE
- 10 NOT USED
- 11 CORRUGATED, PRE-FINISHED METAL SIDING; EXPOSED FASTENERS WITH NEOPRENE GASKETS; NU-WAVE BY AEPSPAN
- 12 NOT USED
- 13 FLEXIBLE, SELF-ADHERED A.B. / W.R.B. SILL MEMBRANE; PER INSTALLATION INSTRUCTIONS ON SHEET A6.4
- 14 CONT. BACK DAM ANGLE. MIN. 1-INCH TALL WITH VINYL ASSEMBLY FASTENED THROUGH ANGLE PER MFR. RECOMMENDATIONS.
- 15 ONE PART URETHANE SEALANT OVER BACKER ROD; FOAM BACKER ROD W/ BOND BREAKER JACKET - OVERSIZE ROD 25% LARGER THAN WIDTH OF JOINT; CLEAN SUBSTRATE USING A "TWO CLOTH" METHOD PER SEALANT MANUFACTURER - PRIME PER MFR ONLY WHERE REQUIRED.
- 16 CONTINUOUS AIR BARRIER SEALANT OVER BACKER ROD (WHEN SHOWN) TIED TO CONTINUOUS SEAL AT WINDOW PERIMETER.
- 17 1/4-INCH WITH PAINTABLE CAULK
- 18 NOT USED
- 19 NOT USED
- 20 PRIMED COUNTER-FLASHING ACCESSORY ABOVE TRIM OR RIP SLOPE IN TOP OF TRIM AND 1/4-INCH CAULK AT JOINT; PROVIDE 1/4-INCH PER FOOT SLOPE.
- 21 PRE-FINISHED SHEET METAL SILL FLASHING W/ 1/2-INCH HEMMED DRIP EDGE WITH END DAMS INTO BED JOINT AT JAMB VENEER TRIM BEYOND
- 22 PRIMED SHEET METAL HEAD FLASHING W/ 1/2" HEMMED DRIP EDGE & END DAMS. EXTEND 6-INCHES MINIMUM UP UNDER THE A.B. / W.R.B. AND OVERLAP JAMB TRIM
- 23 PRE-FINISHED SHEET METAL JAMB FLASHING TRIM
- 24 EXTRUDED ALUMINUM HORIZONTAL TRIM ACCESSORY (BY EXTREMETRIM OR APPROVED); PAINT PER MFR'S RECOMMENDATIONS; APPROXIMATE CONFIGURATION AS SHOWN.
- 25 5 x 5 x 5/16" x 5" TALL GALV. STEEL ANGLE CLIP; (2) AT EACH SIDE OF GUARDRAIL ASSEMBLY; NOTE THAT THE ATTACHMENT TO THE WALL STRUCTURE SHALL BE CONCEALED BEHIND CLADDING.
- 26 1/4" THICK NEOPRENE PAD BETWEEN VERTICAL ALUMINUM GUARDRAIL POST AND GALV. STEEL CLIP.
- 27 PRE-FINISHED ALUMINUM GUARDRAIL ASSEMBLY; FACE-MOUNT ATTACHMENT PER STRUCTURAL.
- 28 FLEXIBLE, SELF-ADHERED A.B. / W.R.B. MEMBRANE; USE 12-INCH WIDE GRACE VYCOR SILL PAN FLASHING W/ END DAMS. WRAP UP SIDEWALL 4" MIN. ABOVE TOP OF FINISH FLOOR

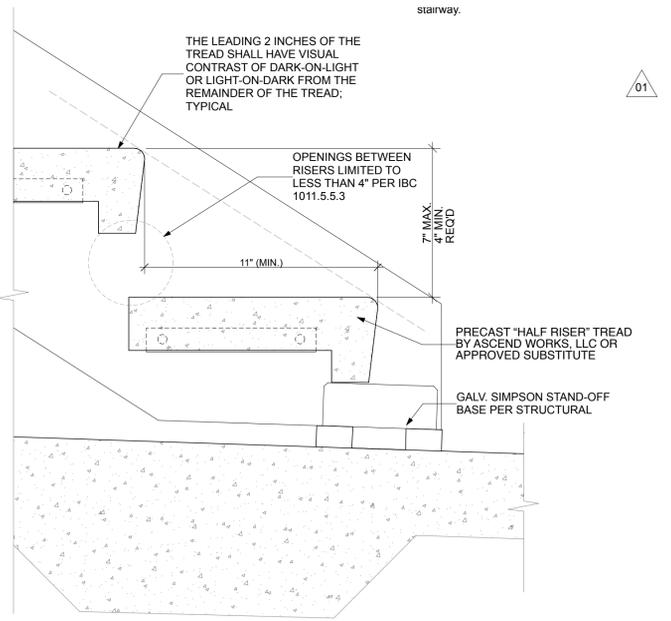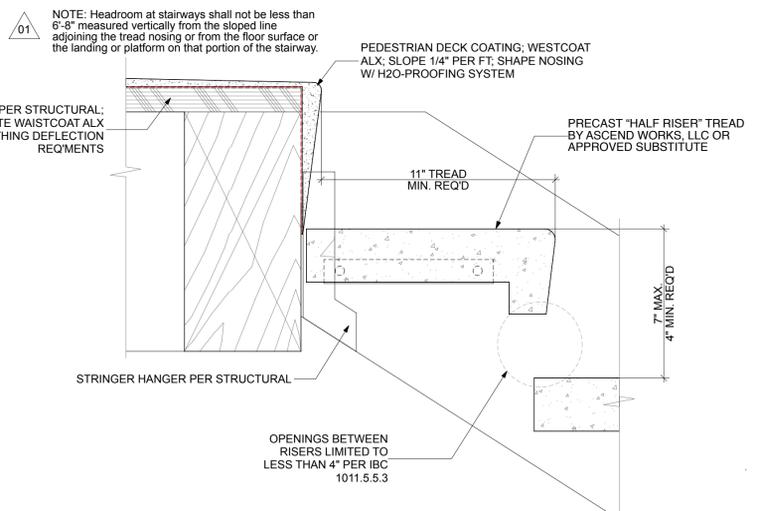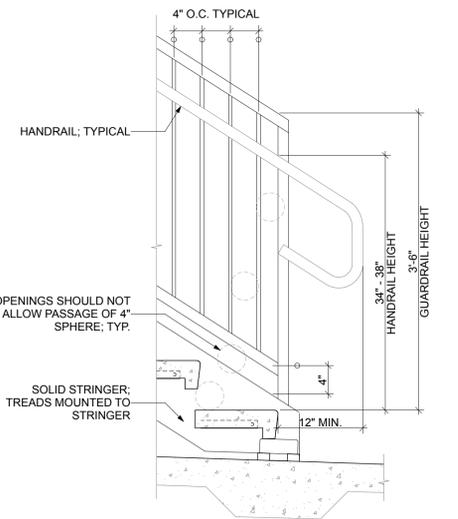

SYNTHESIS 9, LLC
1214 N. D ST
TACOMA, WA 98403

RELISE OF DOCUMENTS
THIS DOCUMENT AND THE EXHIBITS HEREON
INCORPORATED HEREIN AS PERMITS OR
PROFESSIONAL SERVICE ARE THE PROPERTY OF
SYNTHESIS 9, LLC AND ARE NOT TO BE LOANED OR
REPRODUCED IN WHOLE OR IN PART WITHOUT THE
WRITTEN AUTHORIZATION OF SYNTHESIS 9, LLC.

REGISTERED ARCHITECT
BRUCE M. WALKER
STATE OF WASHINGTON
9251

PRGA20250487

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building Planning
Engineering Public Works
Fire Traffic

EAST TOWN CROSSING
BUILDING 'A'
3002 E PIONEER WAY PUYALLUP WA 98372

REVISIONS	
01	RESPONSE TO 1st REVIEW; 2025.08.05
02	RESPONSE TO 2nd REVIEW; 2025.07.31


AGENCY REVIEW - REVISION No.2 | 25.08.29

DRAWN BY: BL / CM
CHECKED BY: BL
DATE: 25.08.29
TITLE: DETAILS
PROJECT #: 2016
SHEET:


A6.3

GENERAL WATERPROOFING NOTES:


- CONTRACTOR SHALL FOLLOW SYNTHESIS 9, LLC SPECIFIED WATERPROOFING SYSTEMS AND INCORPORATION THEREOF. CONTRACTOR SHALL VERIFY THE MATERIAL COMPATIBILITY OF ALL WATERPROOFING COMPONENTS, SUCH AS SEALANTS, CLOSED CELL BAKER ROD, SELF-ADHERING MEMBRANE, ETC., UTILIZED IN CONJUNCTION WITH OTHER WATERPROOFING OR BUILDING SYSTEM COMPONENTS, SHOULD THE CONTRACTOR DECIDE TO REQUEST MATERIAL SUBSTITUTION FROM THOSE SPECIFIED BY SYNTHESIS 9, LLC.
- PRIOR TO PURCHASING AND ERECTION, THE CONTRACTOR SHALL PROVIDE SYNTHESIS 9, LLC FOR THEIR APPROVAL. SHOP DRAWINGS AND SPECS FOR ALL METAL FLASHINGS AND COUNTER-FLASHINGS IN AN ATTEMPT TO DEMONSTRATE THEIR UNDERSTANDING OF THE DETAILS.
- CONTRACTOR IS SOLELY RESPONSIBLE FOR QUALITY CONTROL AND ASSURANCE OF THE WORK PERFORMED BY THE CONTRACTOR, ITS AGENTS, EMPLOYEES, OR ANY SUBCONTRACTOR EMPLOYED OR OTHERWISE PAID BY THE CONTRACTOR. CONTRACTOR IS FURTHER RESPONSIBLE FOR PROPER INTEGRATION OF BUILDING COMPONENTS TO PROVIDE A WEATHER-RESISTIVE BUILDING SYSTEM AS INTENDED BY THE DETAILS PROVIDED BY SYNTHESIS 9, LLC.
- CONTRACTOR SHALL BE RESPONSIBLE FOR THE MEANS AND METHODS OF WORK AND SHALL CARRY OUT ALL WORK IN COMPLIANCE WITH THE BEST INDUSTRY STANDARDS AND IN COMPLIANCE WITH PUBLISHED MANUFACTURER'S INSTALLATION INSTRUCTIONS AND STANDARDS REFERENCED IN THE SPECIFICATIONS.
- MOCKUP OF ALL BUILDING ENVELOPE COMPONENTS SUCH AS WINDOWS, DOORS, WRB, CLADDING, AND PENETRATION INSTALLATIONS MUST BE CARRIED OUT PRIOR TO COMMENCEMENT OF EXTERIOR ENVELOPE WORK.
- SYNTHESIS 9, LLC DETAILS MAY NOT BE MODIFIED, REVISED, OR ELIMINATED BY THE CONTRACTOR WITHOUT PRIOR WRITTEN CONSENT OF SYNTHESIS 9, LLC.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO NOTIFY AND SCHEDULE SYNTHESIS 9, LLC PERSONNEL FOR INSPECTION AND APPROVAL OF THE WORK PERFORMED WITH RESPECT TO EACH OF THE WATERPROOFING COMPONENTS.
- UNLESS OTHERWISE NOTED, ALL EXPOSED METAL FLASHINGS AND COUNTER-FLASHINGS SHALL BE MADE OF MINIMUM 24 GA PRE-FINISHED SHEET METAL. METAL FLASHING SHALL CONFORM TO SMACNA, NRCA, BUILDING CODE AND OTHER RELEVANT CODES AND INDUSTRY STANDARDS. THE VERTICAL LEGS OF SAID FLASHINGS SHALL BE MINIMUM SIX INCHES LONG. THE JOINTS OF PRE-FINISHED METAL FLASHINGS SHALL BE BENT IN PLACE SUCH AS TO PREVENT MOISTURE MIGRATION PAST THE END DAMS. ALL CONCEALED METAL FLASHING AND COUNTER-FLASHING PIECES SHALL BE 24 GA G-90 GALVANIZED SHEET METAL OR SCHEDULE 307 STAINLESS STEEL. JOINTS OF ALL FLASHING PIECES OTHER THAN PRE-FINISHED METAL MUST BE WELDED OR SOLDERED. ALL METAL FLASHING SYSTEMS SHALL BE MANUFACTURED & INSTALLED IN ACCORDANCE WITH THE ARCHITECTURAL SHEET METAL MANUAL PUBLISHED BY SMACNA. UNLESS OTHERWISE NOTED, ALL METAL HEAD FLASHINGS SHALL HAVE A MINIMUM 1/2"-TALL END-DAMS. UNLESS OTHERWISE NOTED, ALL SILL PAN FLASHINGS SHALL HAVE END- AND BACK-DAMS. UNLESS OTHERWISE NOTED, ALL FLASHINGS AND COUNTER FLASHINGS (METAL AND OTHERWISE) SHALL BE SET IN A CONTINUOUS BEAD OF NON-SKINNING BUTYL SEALANT OR APPROVED EQUAL.
- UNLESS OTHERWISE NOTED, ENGINEERED SEALANT JOINTS SHALL BE 1/2-INCH MINIMUM WIDE BY 1/4-INCH MINIMUM DEEP IN AN ATTEMPT TO MAINTAIN A 2:1 RATIO. SEALANTS SHALL BE ONE-PART SILICONE SEALANT & SINGLE-PART POLYURETHANE FOR SURFACE APPLICATION AND NON-SKINNING BUTYL FOR INSTALLATION BETWEEN CONCEALED MATERIAL INTERFACES. ACCEPTABLE SEALANTS INCLUDE BUT NOT LIMITED TO DOW CORNING 790 AND 795 SILICONE BUILDING SEALANT, SIKAFLEX 15 LM, AND SONOLASTIC 150 VLM.
- WEATHER-RESISTIVE BARRIER (WRB) SHALL BE COMPRISED OF (1) LAYER OF HIGH-PERFORMANCE VAPROSHIELD-WRAPHIELD BREATHABLE UNDERLAYMENT MANUFACTURED BY VAPROSHIELD, LLC. NO SUBSTITUTION IS ALLOWED WITHOUT PRIOR APPROVAL FROM SYNTHESIS 9, LLC AND THE OWNER.
- WINDOW AND DOOR UNITS INSTALLED WITHIN THE EXTERIOR WALL SYSTEM MAY NEED TO E FURRED OUT TO ALLOW FOR PROPER DRAINAGE. IF THIS IS THE CASE, THE FURRING MATERIAL SHALL BE PVC BATTENS OR PRESSURE-TREATED SOLID BLOCKING.
- THE ROUGH OPENING FOR WINDOWS MUST BE 1/2" WIDER AND 1/2"+ TALLER THAN THE WIDTH & HEIGHT OF THE WINDOW UNIT AS THE SILL PAN WILL LEFT THE WINDOW UNITS BY APPROXIMATELY 1/8" TO 1/4" OFF THE SILL.
- UNLESS OTHERWISE NOTED ON THE PLANS, ALL WOOD BLOCKINGS SHALL BE PRESSURE-TREATED LUMBER IF SUCH MATERIAL IS CUT ONSITE. CUT ENDS MUST BE TREATED WITH STANDARD WOOD PRIMERS IMMEDIATELY.
- FURRING BATTENS SHALL BE EITHER 1X4 CEDAR OR BORATE-TREATED LUMBER OR 3/4" BY 1-7/8" PVC VAPROBATTEN MANUFACTURED BY VAPROSHIELD LLC. FURRING BATTENS SHALL ONLY BE INSTALLED VERTICALLY. FURRING BATTENS MUST BE INSTALLED DIRECTLY OVER STUDS SPACED NO MORE THAN 16" O.C. FURRING BATTENS MUST BE SECURELY ATTACHED TO THE STUDS USING APPROVED FASTENERS. ENSURE THAT THE FASTENERS FOR SIDING INSTALLATION ARE LONG ENOUGH TO PENETRATE THROUGH THE FURRING BATTENS, SHEATHING(S) AND INTO STUDS A MINIMUM OF 1/2". WHERE DISSIMILAR MATERIALS ABUT, INSTALL FURRING BATTENS DIRECTLY BEHIND MATERIAL TRANSITIONS. CUT ENDS OF BORATE TREATED LUMBER MUST BE TREATED WITH STANDARD WOOD PRIMERS IMMEDIATELY.
- INSECT SCREENS SHALL BE PROVIDED AT TOP & BOTTOM OF THE WALLS AS WELL AS TOP & BOTTOM OF ANY AND ALL WALL PENETRATIONS. IT SHALL BE EITHER 3/4" MINIMUM VAPROVENT STRIP / VAPROVENT HOOK STRIP OR METAL BUG SCREEN. THE SCREEN / STRIP MUST BE INSTALLED CONTINUOUSLY.
- WINDOW AND DOOR PENETRATION WRAPS SHALL CONSIST OF VAPROSHIELD-WRAPHIELD MANUFACTURED BY VAPROSHIELD LLC. INSTALL PENETRATION WRAPS PER MANUFACTURER'S RECOMMENDATIONS AS WELL AS THE WATERPROOFING DETAILS. USE FACTORY PRE-FORMED CORNERS. USE APPROPRIATE PRIMER FOR APPLICATIONS AT EXTERIOR SHEATHING OR WHERE THE SURFACE TEMPERATURE IS BELOW 40-DEGREE FAHRENHEIT PURSUANT TO THE MANUFACTURER'S INSTRUCTIONS.
- UNLESS OTHERWISE NOTED, SELF-ADHERING MEMBRANE (S.A.M.) SHALL BE MINIMUM OF 9" WIDE WRAPHIELD S.A.M. MANUFACTURED BY VAPROSHIELD LLC; OR THERMFLASH. USE APPROPRIATE PRIMER FOR APPLICATIONS AT EXTERIOR SHEATHING OR WHERE THE SURFACE TEMPERATURE IS BELOW 40-DEGREES FAHRENHEIT PER MANUFACTURER'S RECOMMENDATIONS.
- WHERE THROUGH WALL PENETRATIONS OCCUR (e.g., HOSE BIBS, PIPES, ELECTRICAL BOXES, LIGHT FIXTURES, ETC.) INSTALL 30-MIL THERM FLASH PENETRATION WRAP & BUTYL TAPE AS WELL AS WRB APRONS PER WATERPROOFING DETAILS.
- AT ALL CONSTRUCTION & COLD JOINTS, APPLY APPROVED BENTONITE WATERSTOP. BASIS OF DESIGN IS CETCO VOLCLAY RX-101 WATERSTOP. CONCRETE SHALL BE TOOLED, CLEANED, AND PRIMED BEFORE INSTALLING WATERSTOP MEDIUM.
- THE ROOFING FOR LOW-SLOPE ROOF SHALL BE A 60 MIL PVC, SINGLE-PLY ROOFING SYSTEM. BASIS OF DESIGN IS **JOHNS-MANVILLE**. INSTALL CRICKETS ON ROOF SURFACES WHERE NEEDED TO ALLOW FOR PROPER SLOPE AND DRAINAGE. WHERE PARAPET WALLS OCCUR, ROOF MEMBRANE SHALL WRAP OVER TOP PLATE AND WRAP OVER WRB 5" MINIMUM. INSTALL MEMBRANE IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS & NRCA ROOFING, AS WELL AS WATERPROOFING DETAILS PROVIDED. INSTALL FLASHINGS & COUNTER-FLASHINGS AT ALL TRANSITIONS AND JUNCTIONS IN ACCORDANCE WITH THE WATERPROOFING DETAIL PROVIDED HEREIN AS WELL AS NRCA, SMACNA AND THE BUILDING CODE REQUIREMENTS.
- THE ROOFING FOR SLOPED ROOF AREAS SHALL BE AN ASPHALT SHINGLE OVER UNDERLAYMENT ROOFING SYSTEM. BASIS OF DESIGN IS **GAF, TIMBERLINE NS SHINGLE**. INSTALL CRICKETS ON ROOF SURFACES WHERE NEEDED TO ALLOW FOR PROPER SLOPE AND DRAINAGE. INSTALL SYSTEM IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS, NRCA ROOFING, AS WELL AS WATERPROOFING DETAILS PROVIDED. INSTALL FLASHINGS & COUNTER-FLASHINGS AT ALL TRANSITIONS AND JUNCTIONS IN ACCORDANCE WITH THE WATERPROOFING DETAIL PROVIDED HEREIN AS WELL AS NRCA, SMACNA AND THE BUILDING CODE REQUIREMENTS.
- COPING FLASHING SHALL BE ATTACHED WITH CONTINUOUS CLEAT ON THE OUTSIDE FACE OF PARAPET WHICH WILL BE ATTACHED TO THE PLATE @ 24" O.C. NO PENETRATION IS ALLOWED IN TOP OF COPINGS. ALL SEAM JOINTS MUST BE 3/4" TALL STANDING SEAM. ALL COPINGS SHALL BE MINIMUM 24 GA PREFINISHED SHEET METAL UNLESS OTHERWISE NOTED. COORDINATE DIMENSIONS & SLOPES OF COPING WITH OTHER DETAILS AND PLANS.
- FIBER-CEMENT SIDING SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF JAMES HARDIE INSTALLATION INSTRUCTIONS OR AS PER THE OTHER F.C. MANUFACTURER'S REQUIREMENTS AS WELL AS WATER PROOFING DETAILS PROVIDED HEREIN. INSTALL A LAYER OF APPROVED PROTECTION MEMBRANE (e.g., FLASHING SHEET OR W.R.B.) BEHIND ALL BUTT JOINTS.
- METAL ROOF PANELS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. ROOF PANELS SHALL BE INSTALLED OVER ONE LAYER OF 30# ROOF FELT AND ONE LAYER OF HIGH-TEMP GRACE ULTRA.
- ALL FASTENERS SHALL BE EITHER STAINLESS STEEL OR DOUBLE-DIPPED, HOT-DIPPED OR HEAVY-DIPPED GALVANIZED CONFORMING TO ASTM A153. ELECTRO-GALVANIZED FASTENERS MUST NOT BE USED UNDER ANY CIRCUMSTANCES.
- UNDER SLAB VAPOR BARRIER SHALL BE A CLASS B 15 MIL GEOMEMBRANE CONFORMING TO ASTM E-1745. BASIS OF DESIGN IS STEGO WRAP 15MIL WITH STEGO TAPE, MANUFACTURED BY STEGO INDUSTRIES.
- MAINTAIN A MINIMUM OF 6" SEPARATION BETWEEN FINISH GRADE AND UNTREATED FRAMING MATERIALS.
- SLOPE ALL DECKS, WALKS, AND PATIOS AWAY FROM THE BUILDING WITH A MINIMUM SLOPE OF 1/4" PER FOOT. INSTALL CRICKETS ON DECK SURFACES WHERE NEEDED TO ALLOW FOR PROPER SLOPE AND DRAINAGE. AT A MINIMUM 1/4" PER 1' SLOPE MUST BE PROVIDED TOWARD ROOF GUTTERS, DRAINS OR SCUPPERS.
- ANY DISCREPANCY NOTED BY THE CONTRACTOR MUST BE BROUGHT TO THE ATTENTION OF SYNTHESIS 9, LLC IMMEDIATELY. WHERE DISCREPANCY OCCURS BETWEEN VARIOUS CONTRACT DOCUMENTS, CONTRACTOR SHALL FOLLOW THE MOST STRINGENT REQUIREMENT FOR EACH CATEGORY.
- CONTRACTOR SHALL SUPPLY AND INSTALL FLASHINGS AND COUNTER-FLASHINGS AT ALL TRANSITIONS AND JUNCTIONS PURSUANT TO THE REQUIREMENTS OF THE BUILDING CODE, INDUSTRY STANDARDS INCLUDING SMACNA, EVEN IF SUCH FLASHING IS NOT SPECIFICALLY CALLED OUT FOR IN A DETAIL PROVIDED FOR HEREIN.
- IT IS ASSUMED THAT THE EXTERIOR ENVELOPE SYSTEM IS A NON-AIR-BARRIER SYSTEM.
- WEATHER EXPOSED CONCRETE WALLS & BRICK VENEER UNITS SHALL BE TREATED AS PER PLANS WITH ONE OF THE FOLLOWING PRODUCTS: (A) WATER REPELLANT: BASF - HYDROZO CLEAR 40 VOC; (B) NON-SACRIFICIAL GRAFFITI RESIST. COATING: PERMASHIELD; (C) SACRIFICIAL GRAFFITI RESIST. COATING: VS-1-200 VANDAL SHIELD. APPLY SEALERS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.

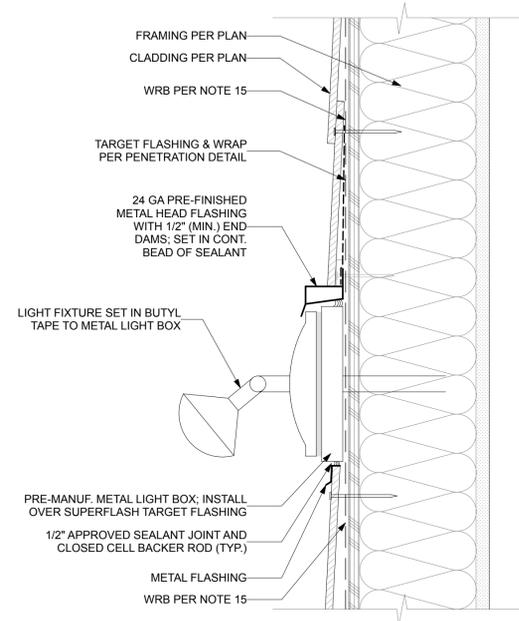


3 FLASHING @ LIGHT FIXTURE
SCALE: 3" = 1'-0"

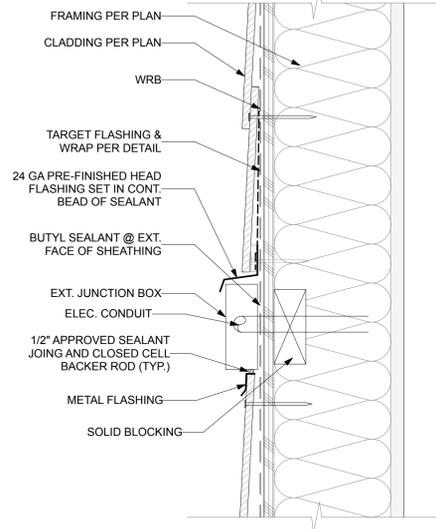


2 JUNCTION BOX PENETRATION
SCALE: 3" = 1'-0"

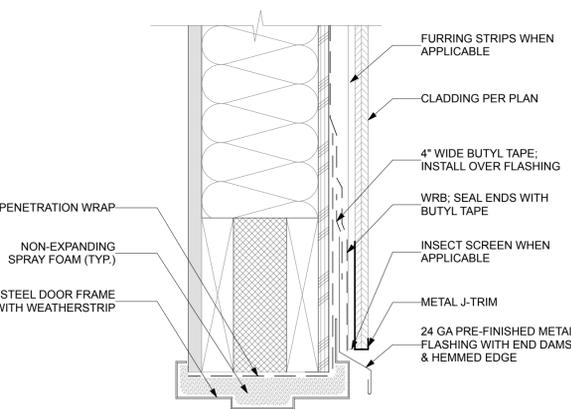

5 DOOR HEAD AT EXTERIOR WALL
SCALE: 3" = 1'-0"

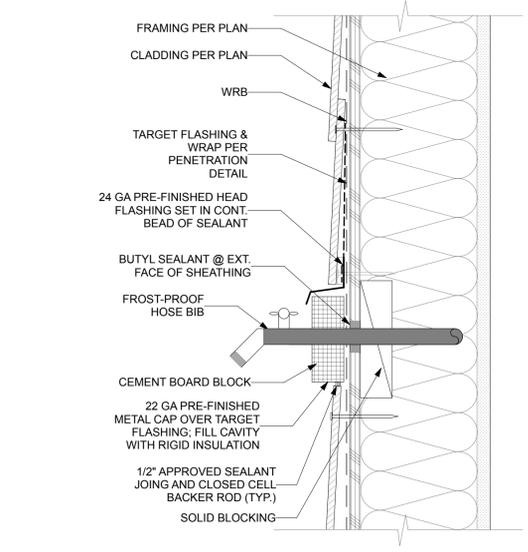

4 FLASHING AT HOSE BIB
SCALE: 3" = 1'-0"

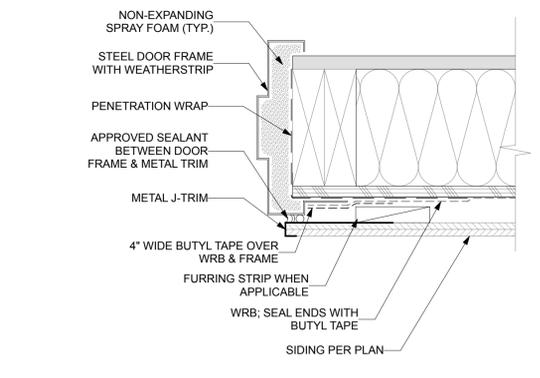

6 DOOR JAMB AT EXTERIOR WALL
SCALE: 3" = 1'-0"



SYNTHESIS 9, LLC
6214 S ST
TACOMA, WA 98403

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE DESIGNATIONS INCORPORATED HEREIN AS INSTRUMENTS OF PROFESSIONAL SERVICE ARE THE PROPERTY OF SYNTHESIS 9, LLC AND ARE NOT TO BE USED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN AUTHORIZATION OF SYNTHESIS 9, LLC.

REGISTERED ARCHITECT
BRITAIN MANVILLE
SHEET # 11.01
STATE OF WASHINGTON

PRGA20250487

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building Planning
Engineering Public Works
Fire Traffic

EAST TOWN CROSSING
BUILDING 'A'
3002 E PIONEER WAY PUYALLUP WA 98372

REVISIONS	
01	RESPONSE TO 1st REVIEW: 2025.08.05
02	RESPONSE TO 2nd REVIEW: 2025.07.31

REVISIONS


DRAWN BY: BL / CM
CHECKED BY: BL
DATE: 25.08.29
TITLE: DETAILS
PROJECT #: 2016
SHEET:

A6.4


AGENCY REVIEW - REVISION No.2 | 25.08.29

NON-FLANGED DOOR BEFORE WATER-RESISTIVE BARRIER (WRB) IS INSTALLED

STEP 1
ATTACH APRON WRB UNDER SILL (S). APRON SHOULD EXTEND AT LEAST 10" BEYOND SIDES OF ROUGH OPENING JAMBS (OR TO FIRST STUD IN OPEN STUD CONSTRUCTION), AND FAR ENOUGH BELOW THE ROUGH OPENING TO OVERLAP THE SILL PLAN OR THE WRB BELOW. THE TOP OF THE APRON SHOULD BE SECURELY ATTACHED TO THE WALL AND THE BOTTOM OF THE APRON SHOULD BE LEFT UNSECURED SO IT CAN OVERLAP THE WRB WHICH WILL BE INSTALLED AFTER THE DOOR.

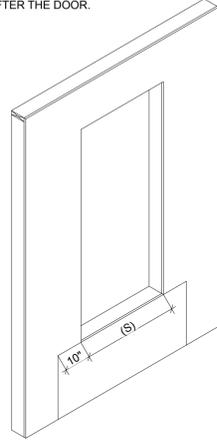


STEP 5 FOR NON-FLANGED DOORS
A. PREPARE HEAD FLASHING BY CUTTING A PIECE OF STRAIGHT FLASH VF AT LEAST 12" LONGER THAN THE HEAD LENGTH.
B. REMOVE THE RELEASE PAPER FROM ONE SIDE OF STRAIGHT FLASH VF.
C. CENTER THE STRAIGHT FLASH VF ALONG THE LENGTH OF THE DOOR AND POSITION SO THAT IT CONTACTS THE DOOR FRAME.
D. BEGINNING AT THE JUNCTION OF THE JAMB AND HEAD AND AWAY FROM THE CORNERS CUT THE STRAIGHT FLASH VF ALONG THE CORNER AT A 45 DEGREE ANGLE.
E. FOLD THE NEWLY CREATED FLASHING FLAPS DOWN PARALLEL TO THE DOOR FRAME.
F. FOLD REMAINING HEAD FLASHING ONTO THE JAMB.

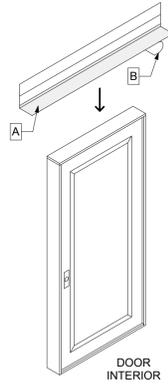

DOOR INTERIOR


STEP 6
A. PREPARE JAMB FLASHING BY CUTTING A PIECE OF STRAIGHT FLASH VF AT LEAST 6" LONGER THAN THE JAMB LENGTH.
B. REMOVE THE RELEASE PAPER FROM ONE SIDE OF STRAIGHT FLASH VF.
C. POSITION SO THAT THE STRAIGHT FLASH VF CONTACTS THE DOOR FRAME UP TO THE EXTERIOR FACE OF THE DOOR. ENSURE THAT THE JAMB FLASHING IS POSITIONED 1 1/2" BELOW TOP OF HEAD FLASHING.
D. REPEAT ON OPPOSITE JAMB.

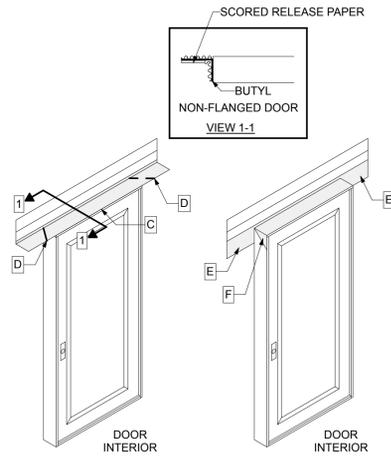

DOOR INTERIOR


DOOR INTERIOR

STEP 9
A. INSTALL DOOR ACCORDING TO MANUFACTURER'S INSTALLATION INSTRUCTIONS.
B. REMOVE THE REMAINING RELEASE PAPER FROM THE STRAIGHT FLASH VF JAMB FLASHING AND PRESS FIRMLY TO ADHERE TO THE WRB.
C. REMOVE THE RELEASE PAPER AT THE HEAD AND ADHERE IT TO THE EXTERIOR SHEATHING OR FRAMING MEMBERS.
OPTIONAL: COVER EXPOSED BUTYL WITH STRAIGHT FLASH, FLASHING TAPE, OR TYVEK TAPE.

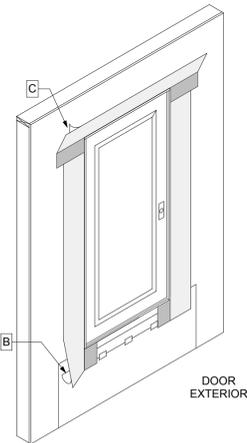


DOOR EXTERIOR

STEP 10 (OPTIONAL - RECOMMENDED BEST PRACTICE)
A. CUT A PIECE OF METAL OR VINYL DRIP CAP SLIGHTLY LONGER THAN THE WIDTH OF THE DOOR AND PLACE A BEAD OF RECOMMENDED SEALANT ON THE REAR SIDE. INSTALL THE DRIP CAP TIGHT AGAINST THE DOOR HEAD AND COVER THE TOP EDGE WITH FLASHING TAPE.

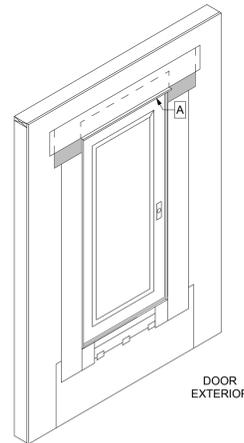


DOOR EXTERIOR

STEP 11
AFTER INSTALLING WRB, CUT AS SHOWN TO EXPOSE DOOR AND APRON. DO NOT CUT THROUGH THE FLASHING SYSTEMS PRODUCTS OR APRON.

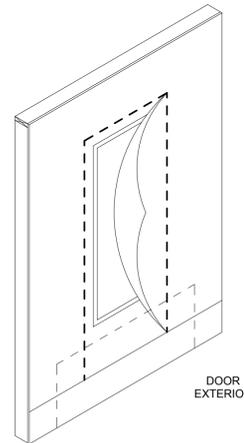

DOOR EXTERIOR


STEP 12
A. TAPE SEAMS AS SHOWN. DO NOT TAPE AT BOTTOM OF OPENING. AT THE HEAD, CONTINUOUS TAPE SEAMS AS SHOWN WITH TYVEK TAPE. SKIP-TAPING AT THE HEAD IS ACCEPTABLE IF AN AIR BARRIER IS NOT REQUIRED OR IF ADDITIONAL DRAINAGE IS DESIRED.
B. LAP BOTTOM OF APRON AND THE WRB OVER BUILDING MATERIALS FOR PROPER SHINGLING.

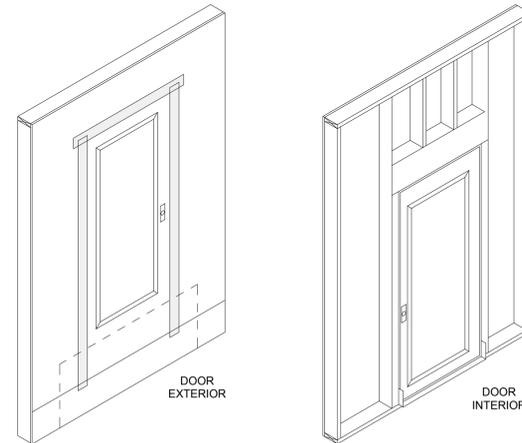


DOOR EXTERIOR

DOOR INTERIOR


STEP 2
A. CUT PIECE OF FLEX WRAP NF AT LEAST 12" LONGER THAN THE WIDTH OF THE SILL (S).
B. FLEX WRAP NF HAS PERFORATED RELEASE PAPER TO HELP WITH THE FORMATION OF THE BACK DAM. TO ENSURE THAT THE PERFORATION TEARS CLEANLY, FOLD THE PERFORATION 180 DEGREES AND CREASE THE FLASHING.
C. REMOVE THE TWO WIDEST PIECES OF RELEASE PAPER LEAVING THE NARROWEST RELEASE PAPER ON THE FLASHING. WHEN THE FINISHED FLOOR IS APPLIED, THE RELEASE PAPER CAN BE REMOVED AND THE BACK DAM CAN BE COMPLETED.

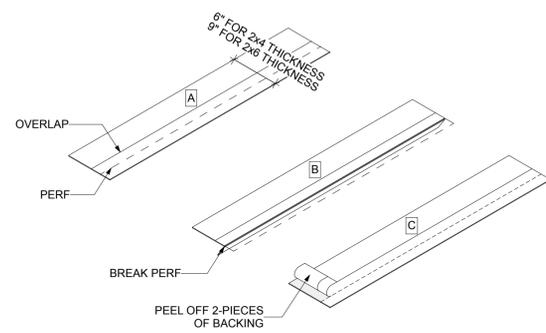

STEP 3 (OPTIONAL BACK DAM)
INSTALL THE SILL FLASHING AS INDICATED LEAVING 1" OF FLEX WRAP NF WITH RELEASE PAPER EXTENDING IT PAS THE DOOR THRESHOLD ON THE INSIDE. WHEN THE 1" OF RELEASE PAPER IS REMOVED, THERE SHOULD BE 3/4" OF FLASHING TO FORM THE BACK DAM.
OPTION 2: SOME FLOORING CANNOT ACCOMMODATE A BACK DAM. IN THAT CASE FOLD THE 1" BACK DAM ON TOP OF FLEX WRAP NF IN THE SILL. DOOR WILL BE INSTALLED ON TOP OF THE 1" FOLD TO CREATE A BACK DAM.

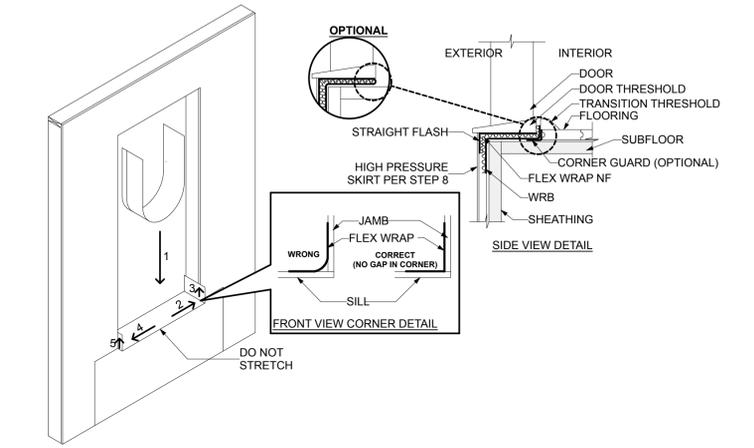


STEP 8 (OPTIONAL - HIGH PRESSURE SKIRT)
A. CREATE THE HIGH PRESSURE SKIRT BY CUTTING A PIECE OF WRB 1" WIDER THAN THE WIDTH OF THE DOOR OPENING AND APPROXIMATELY 10" IN HEIGHT.
B. CUT A PIECE OF STRAIGHT FLASH VF TO THE SAME WIDTH OF SKIRT. REMOVE RELEASE PAPER FROM ONE SIDE OF STRAIGHT FLASH VF AND ADHERE TO WRB. THE SKIRT MAY BE MADE WITH STRAIGHT FLASH VF OR FLASHING TAPE.
C. REMOVE THE RELEASE PAPER FROM THE OTHER SIDE OF STRAIGHT FLASH VF AND ADHERE TO BUTYL ADHESIVE AT THE SILL SKIRT TO THE UNDERSIDE OF THE DOOR THRESHOLD BEHIND THE JAMB FLASHING.
D. SECURE EDGES OF THE OPTIONAL SKIRT WITH TWO 4" PIECES OF STRAIGHT FLASH OR FLASHING TAPE.
E. TAPE THE BOTTOM OF THE OPTIONAL SKIRT TO ALLOW FOR DRAINAGE AND TO MINIMIZE WIND DAMAGE DURING CONSTRUCTION.
F. IF SEALANT IS APPLIED TO THE SILL, INSURE (2) 2" GAPS TO ALLOW FOR DRAINAGE FOR EVERY 4' OF DOOR USING RECOMMENDED SEALANT.

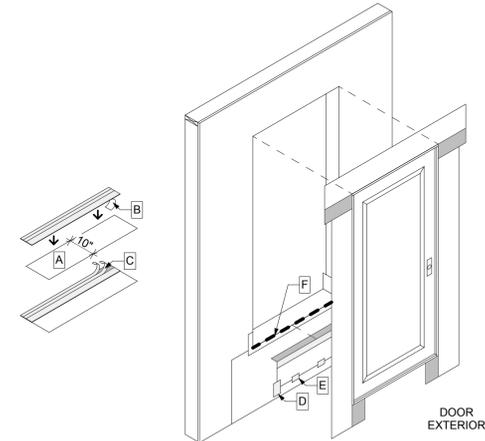

DOOR EXTERIOR

STEP 13
A. WHEN THE INTERIOR FLORING IS READY TO INSTALL, REMOVE RELEASE PAPER AND USE FOLDING OPTION ONE OR TWO TO FORM THE BACK DAM.
B. INSTALL RECOMMENDED SEALANT (AND BACKER ROD AS NECESSARY) AROUND THE OPENING AT THE INTERIOR. IT IS ALSO ACCEPTABLE TO USE RECOMMENDED FOAM. THE SEAL CREATED BY THE SEALANT (AND BACKER ROD AS NECESSARY) OR FOAM WILL ALSO SERVE AS A BACK DAM. SEALANT SHOULD BE TOOLED FLAT TO ALLOW THE NATURAL CURING PROCESS TO CREATE A CONCAVE SHAPE. BE SURE THAT HTE SEALANT PENETRATES THE GROVES OF THE FLEX WRAP NF AROUND THE SILL.

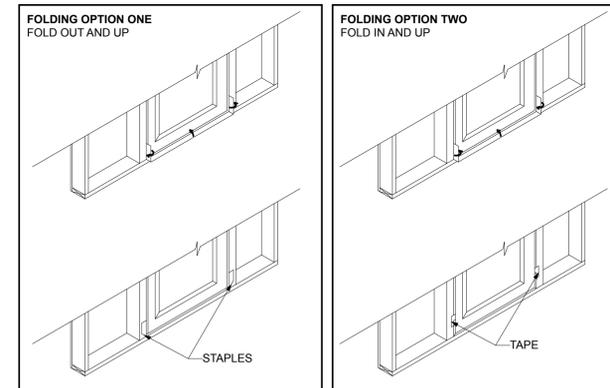

FOLDING OPTION ONE
FOLD OUT AND UP

FOLDING OPTION TWO
FOLD IN AND UP

STAPLES

TAPE

S9
SYNTHESIS 9, LLC
1214 N. 101
TACOMA, WA 98403

REUSE OF DOCUMENTS
THIS DOCUMENT AND THE DRAWINGS HEREON
INCORPORATED HEREIN AS PERMITS OR
PROFESSIONAL SERVICES ARE THE PROPERTY OF
SYNTHESIS 9, LLC AND ARE NOT TO BE USED OR
REPRODUCED IN WHOLE OR IN PART WITHOUT THE
WRITTEN AUTHORIZATION OF SYNTHESIS 9, LLC.

REGISTERED ARCHITECT
BRITTA MULLER LINDSAY
STATE OF WASHINGTON
9251

PRGA20250487
City of Puyallup
Development & Permitting Services
ISSUED PERMIT
Building Planning
Engineering Public Works
Fire Traffic

EAST TOWN CROSSING
BUILDING 'A'
3002 E PIONEER WAY PUYALLUP WA 98372


REVISIONS	
01	RESPONSE TO 1st REVIEW, 2025.08.05
02	RESPONSE TO 2nd REVIEW, 2025.07.31

REVISIONS


DRAWN BY: BL / CM
CHECKED BY: BL
DATE: 25.08.29
TITLE: DETAILS
PROJECT #: 2016
SHEET:

AGENCY REVIEW - REVISION No.2 | 25.08.29


A6.6

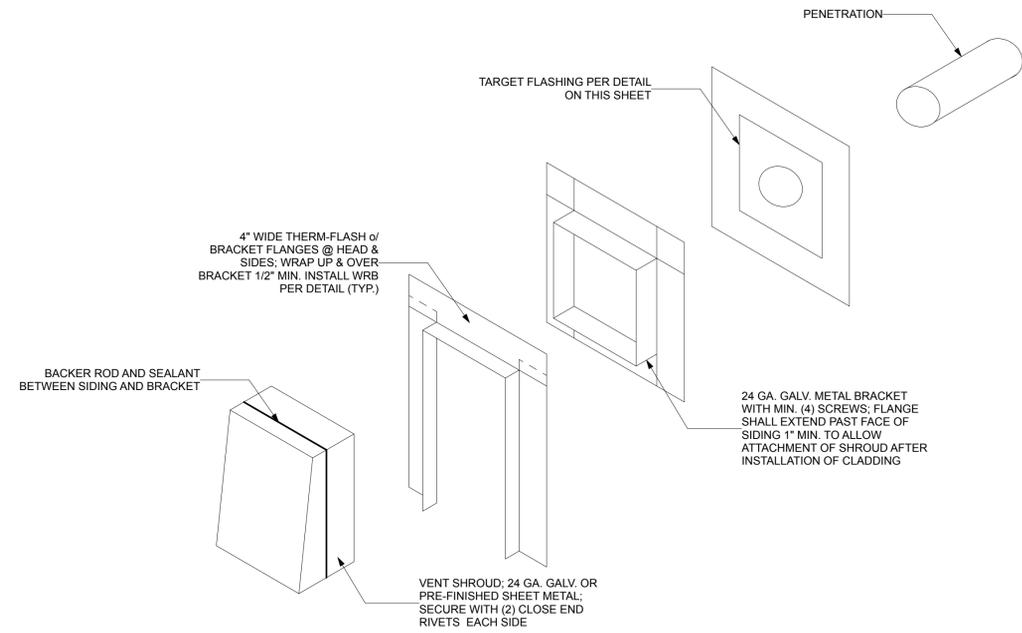


3 VENT PENETRATIONS
SCALE: 3/8" = 1'-0"

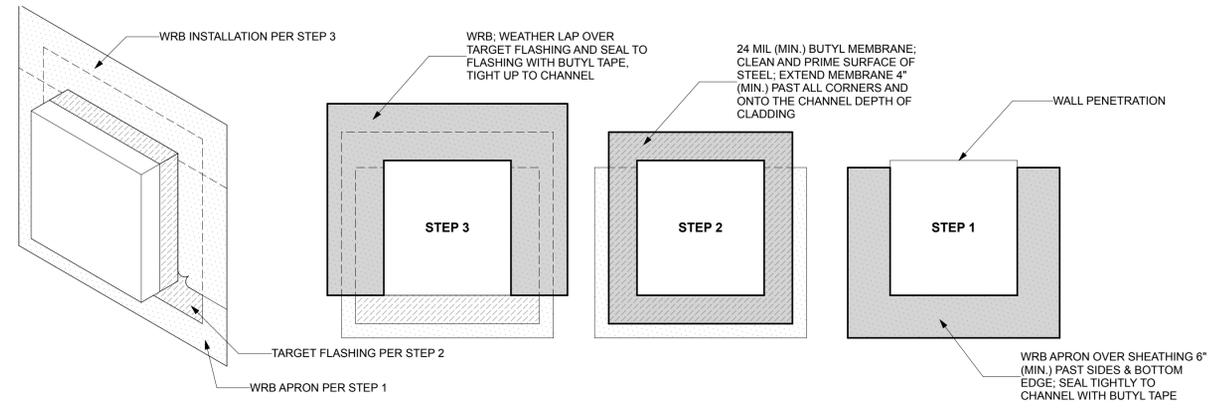


1 TARGET FLASHING INSTALLATION FOR PENETRATIONS > 6"
SCALE: 1" = 1'-0"

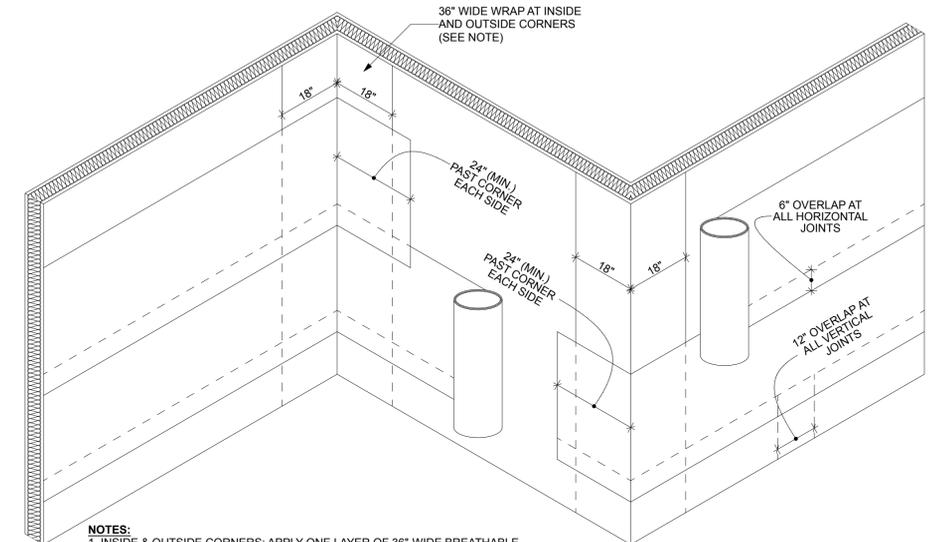


2 WRB INSTALLATION
SCALE: 1/2" = 1'-0"

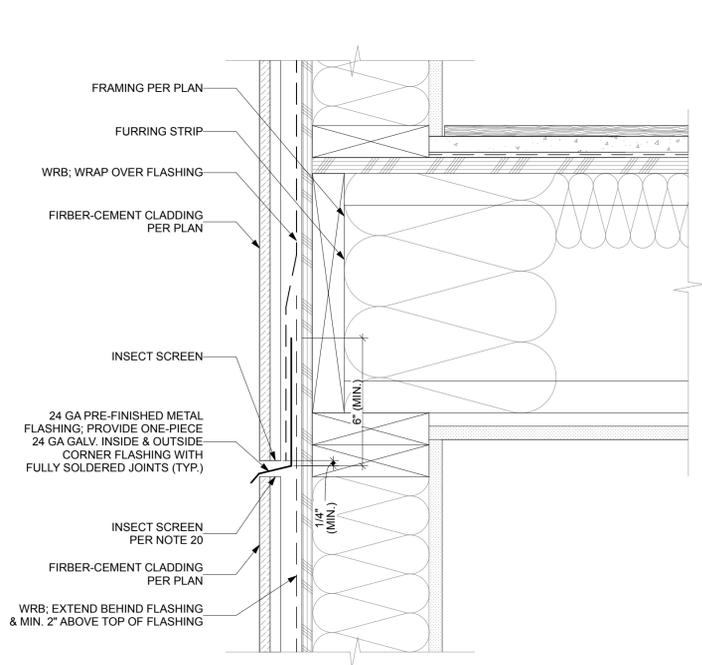

6 THROUGH WALL FLASHING
SCALE: 3\"/>

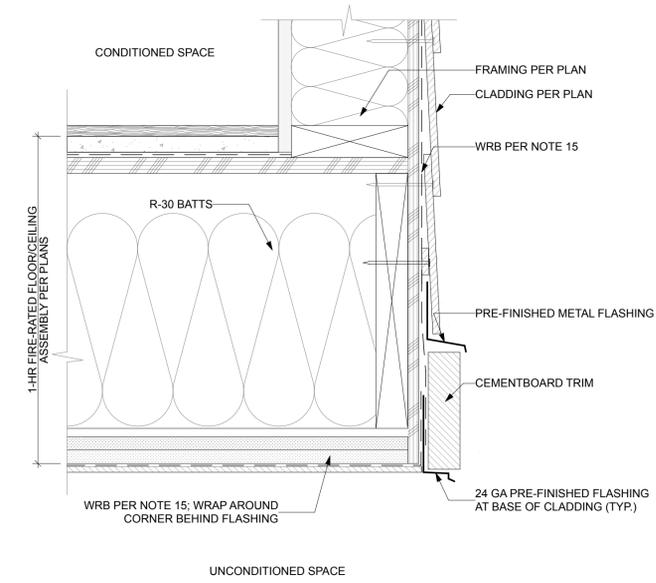

5 BUILDING OVERHANG
SCALE: 3\"/>

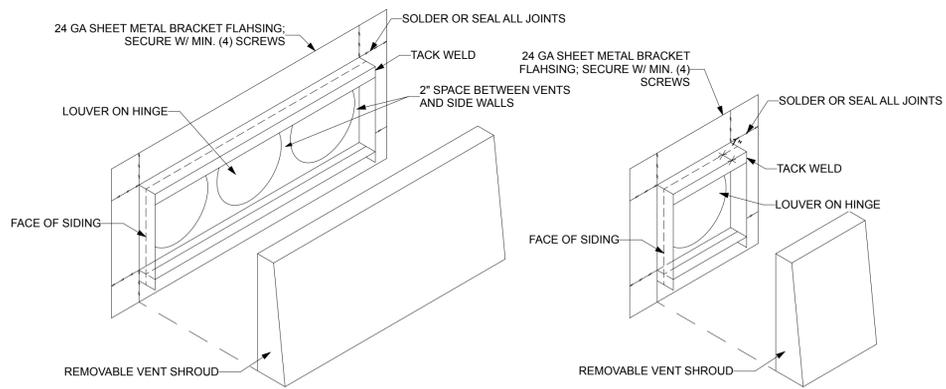


4 VENT SHROUDS
SCALE: 1 1/2\"/>

westcoat SPECIALTY COATING SYSTEMS
WP WATERPROOF RELIABLE MOISTURE BARRIERS
ALX™ Standard Finish

Description
 Westcoat ALX™ Standard is a waterproof walking deck system. It is reinforced with metal lath and is installed with a series of three separate polymer-modified cementitious applications and sealed with Westcoat's SC-10 Acrylic Topcoat. The finished product weighs approximately 2½ lbs per square foot. This system gives plywood the look and feel of concrete with a decorative appeal.

Uses
 ALX™ is designed for use on plywood. It is recommended for the discriminating architect, contractor or building owner that demands the finest in design, strength and durability. ALX™ is ideal for areas with heavy traffic or in cases where elimination of the appearance of plywood seams is essential. ALX™ has been designed for balconies, corridors, stairs and landings. It is regularly specified for hotels, condominiums, apartments and office buildings. ALX™ can be stapled through most old deck systems to provide an excellent method for the rehabilitation of problem surfaces.



System Data

Coverages	Base Coat	Slurry Coat	Texture Coat	Top Coat
	40 ft² per batch	100-150 ft² per batch	150-200 ft² per batch	200-300 ft² per gallon

Components	Shelf Life
WP-10 Stapler	N/A
WP-47A Seam Tape	1 year
WP-25 Metal Lath	N/A
WP-40 Sheet Membrane	1 year
WP-51 Polyurethane Sealant	1-2 years
WP-81 Cement Modifier	2 years
SC-10 Acrylic Topcoat	2 years
TC-1 Basecoat Cement	1 year
TC-3 Medium Texture Cement	1 year

Certifications IAPMO ER-587
 Meets Class A Fire Test ASTM E-108
 Meets One-Hour Fire Rating ASTM E-119
 Meets Class I Vapor Retarder ASTM E96 (when WP-40 is installed over entire deck)
 Meets 2020 City of Los Angeles Building and Residential Code (LABC & LARC)
 Meets Wildland Urban Interface (W.U.I.) Requirements
 Meets the Requirements of Decking SFM 12-7A-4 Parts A & B

DISCLAIMER: PURCHASER'S SOLE AND EXCLUSIVE REMEDY AGAINST THE MANUFACTURER OF WESTCOAT SHALL BE LIMITED SOLELY TO THE REPLACEMENT OF ANY DEFECTIVE MATERIAL OR A PAYMENT BY THE MANUFACTURER IN AN AMOUNT EQUAL TO THE COST OF THE ORIGINAL MATERIAL.

westcoat 4007 Lockridge St • San Diego, CA 92102
 800-250-4519 • Fax 619-255-7187 • westcoat.com ALX™ Standard 5/22

westcoat SPECIALTY COATING SYSTEMS
WP WATERPROOF RELIABLE MOISTURE BARRIERS
ALX™ Standard Finish

Advantages
 Fast Access After Installation • Available Manufacturer's Warranty • Excellent Sound Reduction Qualities • Tough Final Coat is UV Resistant • Covers Rough Plywood and Seams • Skid Resistant Textured Finish • Decorative Finishes Available • Unmatched Strength and Durability

Inspection
 For installation of the ALX™ system, plywood must be minimum ½ inch (¾ inch preferred) CDX or exterior grade. Pressure-Treated plywood should not be used with metal lath systems. Slope must be a minimum of ¼ inch per linear foot and shall provide for proper drainage. Decks should meet local building codes. The deck shall be tongue and groove, properly blocked and nailed (glued and screwed is best). Plywood shall have a maximum joist span of 16 inches. Deflection should be less than L/360. OSB is not a suitable substrate for this material. Moisture vapor commonly collects in areas below a vapor barrier, such as the waterproofing membrane of the deck covering system. Venting must be added to help relieve moisture vapor transmission. Please refer to all local building codes regarding venting requirements.

Preparation
 Be sure the surface is clean, dry and free of grease, paint, oil, dust or any foreign material that may prevent proper adhesion. "Dry" plywood is typically defined as having less than a 10% moisture reading or by showing no moisture with a plastic sheeting test. Applicator is responsible for ensuring that the substrate is acceptable for application. Do not apply to wet plywood.

Sheet Membrane
 Westcoat requires the installation of 6 inch WP-40 Sheet Membrane to all plywood seams for reinforcement. WP-40 may also be installed behind or on top of the flashing as a backup waterproofing measure. For increased adhesion, WP-43 Sheet Membrane Primer may be used prior to applying the Sheet Membrane. WP-40 may not be left exposed to the sun for more than 7 days. See WP-40 Sheet Membrane and WP-43 Sheet Membrane Primer Product Specification Sheets for additional information.

Flashing
 Flashing requires a minimum of 26-gauge bonderized sheet metal. Use 4 x 4 inch 'L' flashing at the junction of the wall and deck. Use 2 x 4 inch drip edge flashing for fascia edge. Overlap all ends at least four inches. Apply two beads of WP-51 Polyurethane Sealant to all seams. Nail flashing every 4-6 inches. (Note: If the flashing is not bonderized, it must be prepared in accordance with SSPC-SP1 surface preparation standards, in order for the coating to adhere properly).

Metal Lath
 Prior to installing the Metal Lath, WP-47A Seam Tape should be applied ½ inch from all deck edges leaving ½ inch of flashing exposed. Place the WP-25 Metal Lath on the plywood and cut it to make sure the edge of the lath is offset two inches from any parallel plywood seam run across the grain of the plywood (across the long seams) when possible. The lath should be placed so that it curves down at the edge of the deck. The lath should be stapled from all deck edges, leaving 1 inch of seam tape in place, start in the center working your way out. The lath should be stapled every 1-2 inches and staple every 1-2 inches higher than the lath.

westcoat SPECIALTY COATING SYSTEMS
WP WATERPROOF RELIABLE MOISTURE BARRIERS
ALX™ Standard Finish

Health Precaution
 Irritation of eyes, nose, throat and lungs. Prolonged or repeated skin contact may cause irritation. Cements contain silica; dust mask or respirator should be used during application or grinding.

Solvent based products are extremely flammable, extinguish all pilot lights and sources of ignition such as electrical motors. Be sure to have adequate cross ventilation prior to installing.

Limitations
 • This system is designed for professional use only.
 • Read Product Specification Sheets for every product you will be using before beginning the project.
 • Do not apply at temperatures below 50°F or above 90°F.
 • Rain will wash away uncured Westcoat acrylic products.
 • If inclement weather threatens, cover deck to protect new application.
 • Sealers will make the surface slippery, please be aware the texture of the surface and how the sealer will affect the look, feel and skid resistance.
 • Approval and verification of proposed colors, textures and slip resistance is recommended.
 • Do not allow Westcoat products to freeze.
 • Moisture vapor commonly collects in areas below a vapor barrier, such as the waterproofing membrane of the deck covering system. Venting must be added to help relieve moisture vapor transmission. Please refer to all local building codes regarding venting requirements.

Slip Precaution
 Westcoat Specialty Coatings Systems highly recommends the use of a slip-resistant additive to all coatings/systems that may be exposed to wet, oily, greasy or slippery conditions. It is the end user's responsibility to provide a flooring system that meets current safety standards. Westcoat and its distributors will not be responsible for injury incurred during a slip and fall incident. For the current coefficient of friction requirements, please consult your local building codes.


westcoat SPECIALTY COATING SYSTEMS
WP WATERPROOF RELIABLE MOISTURE BARRIERS
ALX™ Standard Finish

Base Coat
 Four ½ gallons of WP-81 Cement Modifier and desired water (up to one quart) into a clean mixing bucket and then add one bag of TC-1 Basecoat Cement. Mix until uniform with a mechanical mixer at a low rpm. Pour the mixture (4½ gallons total) onto the lath and with trowel on edge, smooth to the top of the lath at the rate of 40 square feet per batch. Trowel and brush the base coat up to the seam tape edge, leaving ½ inch of flashing exposed. For best results, tape off the flashing. Use a paintbrush to spread the base coat into all corners. Tap the deck with a hammer to help in smoothing out trowel ridges. As soon as it is dry, usually 1 to 2 hours at 70 degrees, scrape off any high spots or ridges that may prevent a smooth slurry coat.

Slurry Coat
 Create the slurry coat by adding one gallon of WP-81 Cement Modifier and up to ½ gallon of water into a clean mixing bucket and add one bag of TC-1 Basecoat Cement. Mix until uniform with a mechanical mixer at a low rpm. Trowel the slurry mix over the surface to achieve a smooth finish. Coverage of the slurry coat is between 100-150 square feet per batch. The Slurry Coat will be applied right up to all of the deck's edges. Using a brush, wet with water, feather all outside edges. After surface is dry (usually 30 minutes to 2 hours at 70 degrees), scrape or grind off any ridges or trowel marks.

Texture Coat
 Four one gallon of WP-81 Cement Modifier in a clean mixing bucket and add one bag of TC-3 Medium Texture Cement. Mix thoroughly with a mechanical mixer at a low rpm. Add up to ½ gallon of water to achieve the desired consistency. Using an acoustical hopper gun, spray the texture onto the deck with a circular motion to achieve approximately 70% coverage at a rate of about 150 to 200 square feet per batch. Spray continuously, do not stop in the middle of the deck. After a few moments, depending on the temperature, the texture must be "knocked down". Use a rounded pool trowel for best results. Wipe the trowel a wet rag as needed. For an Orange Peel Texture, increase the air pressure and red hopper gun. Spray texture evenly at an 80% to 90% coverage rate. If you immediately scrape off and re-spray. After the texture has dried (2-4 hours), scrape any trowel marks and vacuum the surface prior to re-spray.

Topcoat
 Mix all containers of SC-10 adding up to a maximum of two thin coats.

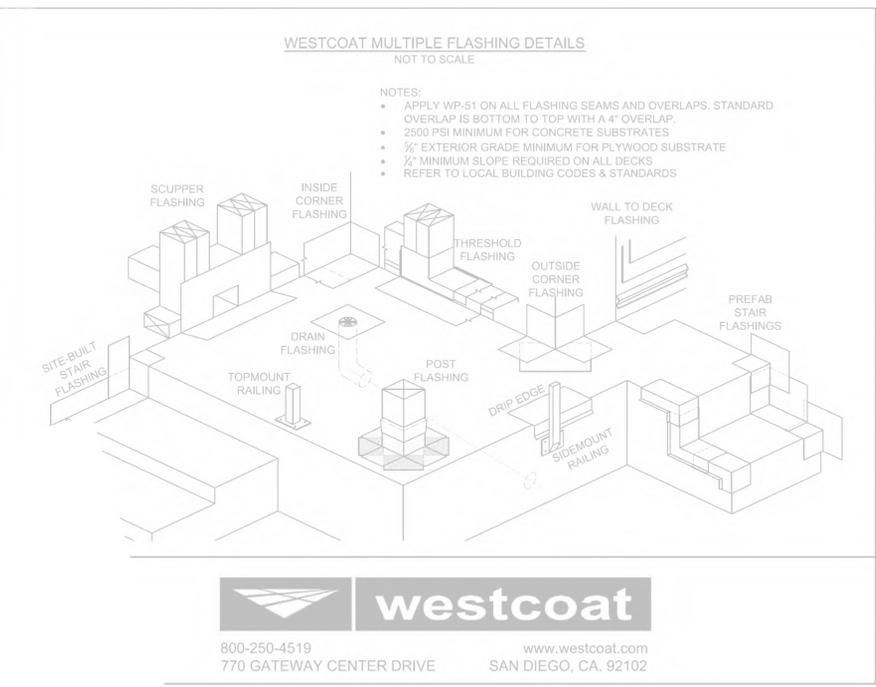


NOT USED

westcoat SPECIALTY COATING SYSTEMS
WP WATERPROOF RELIABLE MOISTURE BARRIERS
ALX™ Standard Finish

Test Data

Test	ALX™ Standard WP-40 On Seams	ALX™ Standard WP-40 Full Coverage
Accelerated Aging ASTM D-756	Pass	Pass
Fire-Retardant Roof Covering ASTM E-108	Class A	Class A
One-Hour Fire Test ASTM E-119	Pass	Pass
Flame Spread ASTM E-84	NFPA Class B	NFPA Class B
Fire-Test-Response of Deck Structures to Burning Brands ASTM 2726-12a	Pass	Pass
Under Deck Fire Test Response of Deck Materials ASTM E2632	Pass	Pass
Water Vapor Transmission of Materials ASTM E96	Pass	Class I Vapor Retarder (01 perm or less)
Bond Strength (Control) ASTM C-297	143 psi	Pass
Bond Strength (Acoust. Aging) ASTM C-297	Pass	Pass
Bond Strength (Freeze-Thaw) ASTM C-297	Pass	Pass
Abrasion ASTM D-1242	.023 inches	.023 inches
Water Absorption ASTM D-570	75%	Pass
Chemical Resistance ASTM D-2299	Pass	Pass
Freeze-Thaw ASTM C-67	5%	5%
Concentrated Load AC-308 Section 4.12	Pass	Pass
Wind Uplift FM L-52	Pass	Pass
Impact Resistance ASTM D-3746	Pass	Pass

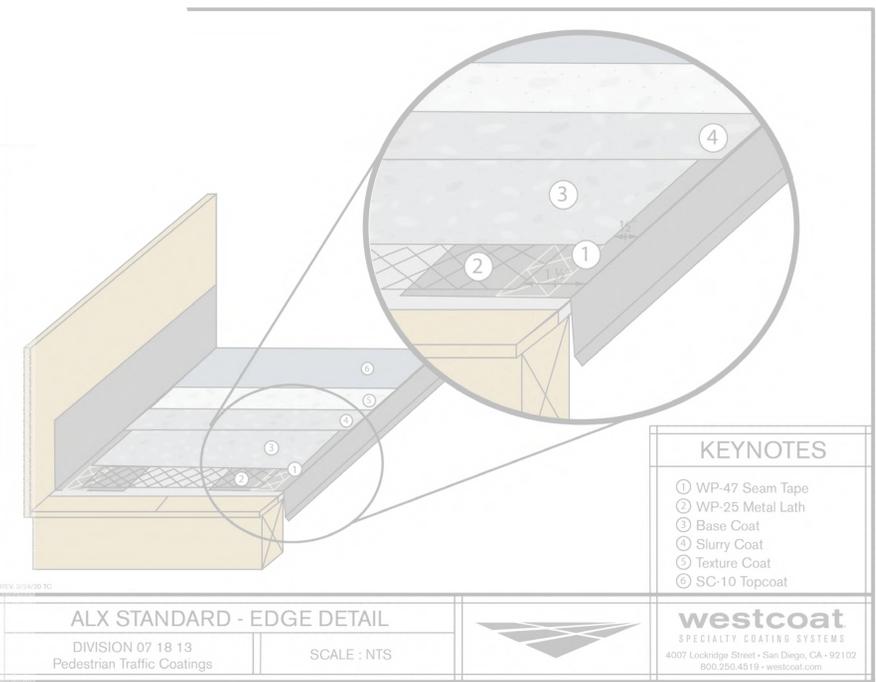

westcoat SPECIALTY COATING SYSTEMS
WP WATERPROOF RELIABLE MOISTURE BARRIERS
ALX™ Standard Finish

Optional Materials
Sheet Membrane
 • WP-40 36 inch can be installed to the entire deck when maximum protection is required.
 • WP-43 Sheet Membrane Primer may be used when increased adhesion is desired.
Cements
 • If a smoother finish with finer texture is required, TC-2 Smooth Texture Cement or TC-5 Grout Texture Cement can be used.
Cement Additives
 • CA-15 Cement Accelerator can be added to Westcoat cements to help reduce dry times.
 • CA-16 Cement Decelerator can be added to Westcoat cements to increase working time during periods of hot weather.
Low Odor Cement Modifier
 • If a lower odor cement modifier is required, WP-82 Cement Modifier Low Odor can be used in lieu of WP-81.
Skid Resistance
 • CA-29 Mini Safe Grip, CA-30 Small Safe Grip or CA-31 Large Safe Grip can be added to the SC-10 Acrylic Topcoat for added skid resistance.
WP Wrap
 • Westcoat's WP Wrap can be used with the ALX System to provide additional waterproofing with reinforcement, along the perimeter of the deck.
Deck Drain
 • If a drain is required, Westcoat's WP-35 ALX™ Deck Drain may be installed between the Sheet Membrane and Metal Lath steps in the application instructions. Please read the WP-35 ALX™ Deck Drain Product Specification Sheet for detailed instructions.
Sloping
 • Westcoat Slope Technique may be used if additional sloping is required. Slope Technique should be applied after the Base Coat and prior to the Slurry Coat.
 * Please refer to Product and System Specification Sheets for additional information.

Clean Up
 Uncured material can be removed with soap and warm water. If cured, material can be removed mechanically or with an environmentally-safe solvent.

Maintenance
 Exterior surfaces can be swept daily with water and a broom. For tougher dirt or grease, use degreaser diluted with water 20:1 and a soft bristle brush or broom. Be sure to rinse well. To remove calcium or lime build up, brush diluted 100 grain vinegar onto the surface; be sure to rinse any residue.

The ALX™ System should be inspected for wear every 2 to 4 years. The system should be resealed with the appropriate Westcoat sealer every 3 to 5 years depending upon traffic and UV exposure. Contact the original installer of Westcoat for complete re-coating instructions.

1 DECK COATING DETAILS
 SCALE: 1" = 1'-0"

S9
 SYNTHESIS 9, LLC
 824 N. ST. TACOMA, WA 98403

REUSE OF DOCUMENTS
 THIS DOCUMENT AND THE DRAWING DESIGN INCORPORATED HEREIN ARE THE PROPERTY OF SYNTHESIS 9, LLC AND ARE NOT TO BE USED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN AUTHORIZATION OF SYNTHESIS 9, LLC.

REGISTERED ARCHITECT
 ISSUE NUMBER
 BRUCE TALLER LINDSAY
 STATE OF WASHINGTON
 0251

PRGA20250487

City of Puyallup
 Development & Permitting Services
 ISSUED PERMIT

Building Planning
 Engineering Public Works
 Fire Traffic

EAST TOWN CROSSING
 BUILDING 'A'
 3002 E PIONEER WAY PUYALLUP WA 98372


AGENCY REVIEW - REVISION No.2 | 25.08.29

REVISIONS
 01 RESPONSE TO 1st REVIEW, 2025.08.05
 02 RESPONSE TO 2nd REVIEW, 2025.07.31

REVISIONS

DRAWN BY: BL / CM
 CHECKED BY: BL
 DATE: 25.08.29
 TITLE: NOT USED
 PROJECT #: 2016
 SHEET:

A6.8

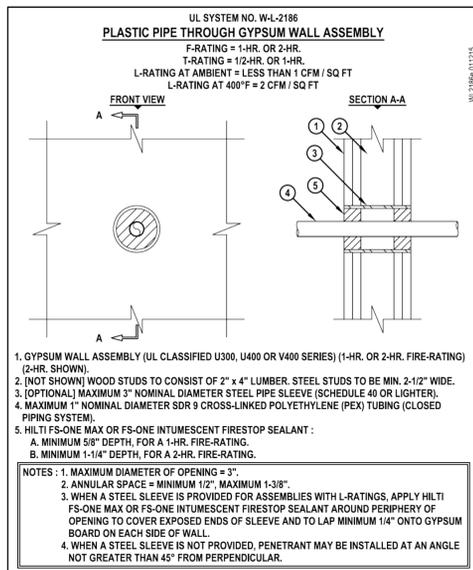


UL SYSTEM NO. W-1-2186
PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 12-HR. OR 1-HR.
 L-RATING AT AMBIENT = LESS THAN 1 CFM / SQ FT
 L-RATING AT 400°F = 2 CFM / SQ FT

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300, U400 OR V400 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. (NOT SHOWN) WOOD STUDS TO CONSIST OF NOMINAL 2" x 4" LUMBER. STEEL STUDS TO BE MIN. 2-1/2" WIDE.
 3. (OPTIONAL) MAXIMUM 3" NOMINAL DIAMETER STEEL PIPE SLEEVE (SCHEDULE 40 OR LIGHTER).
 4. MAXIMUM 1" NOMINAL DIAMETER SDR 9 CROSS-LINKED POLYETHYLENE (PEX) TUBING (CLOSED PIPING SYSTEM).
 5. HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT:
 A. MINIMUM 5/8" DEPTH FOR A 1-HR. FIRE-RATING.
 B. MINIMUM 1-1/4" DEPTH FOR A 2-HR. FIRE-RATING.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 3".
 2. ANNULAR SPACE = MINIMUM 1/2", MAXIMUM 1-3/8".
 3. WHEN A STEEL SLEEVE IS PROVIDED FOR ASSEMBLIES WITH L-RATINGS, APPLY HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT AROUND PERIPHERY OF OPENING TO COVER EXPOSED ENDS OF SLEEVE AND TO LAP MINIMUM 1/4" ONTO GYPSUM BOARD ON EACH SIDE OF WALL.
 4. WHEN A STEEL SLEEVE IS NOT PROVIDED, PENETRANT MAY BE INSTALLED AT AN ANGLE NOT GREATER THAN 45° FROM PERPENDICULAR.

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000 Sheet 1 of 1 Scale 3/16" = 1" Drawing No. WL 2186e Date Jan. 12, 2015

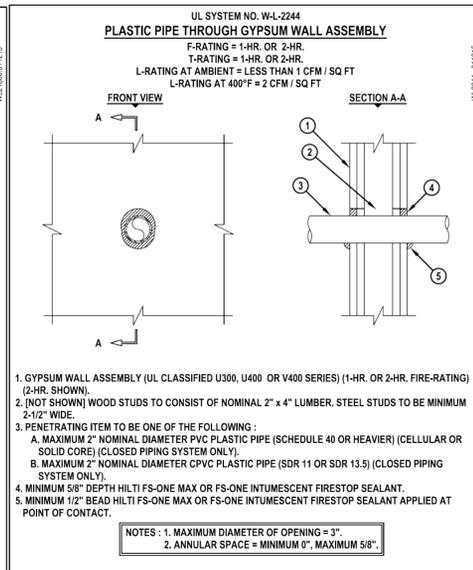


UL SYSTEM NO. W-1-2244
PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 1-HR. OR 2-HR.
 L-RATING AT AMBIENT = LESS THAN 1 CFM / SQ FT
 L-RATING AT 400°F = 2 CFM / SQ FT

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300, U400 OR V400 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. (NOT SHOWN) WOOD STUDS TO CONSIST OF NOMINAL 2" x 4" LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.
 3. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:
 A. MAXIMUM 2" NOMINAL DIAMETER CPVC PLASTIC PIPE (SCHEDULE 40 OR HEAVIER) (CELLULAR OR SOLID CORE) (CLOSED PIPING SYSTEM ONLY).
 B. MAXIMUM 2" NOMINAL DIAMETER CPVC PLASTIC PIPE (SDR 11 OR SDR 13.5) (CLOSED PIPING SYSTEM ONLY).
 4. MINIMUM 5/8" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT.
 5. MINIMUM 1/2" BEAD HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 3".
 2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 5/8".

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000 Sheet 1 of 1 Scale 3/16" = 1" Drawing No. WL 2244e Date Jan. 12, 2015

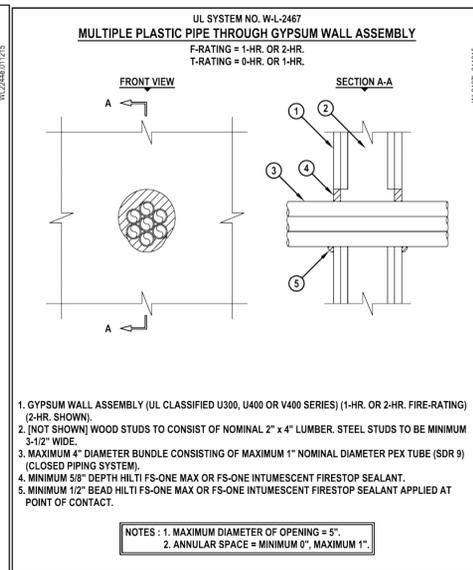


UL SYSTEM NO. W-1-2467
MULTIPLE PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 0-HR. OR 1-HR.

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300, U400 OR V400 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. (NOT SHOWN) WOOD STUDS TO CONSIST OF NOMINAL 2" x 4" LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.
 3. MAXIMUM 4" DIAMETER BUNDLE CONSISTING OF MAXIMUM 1" NOMINAL DIAMETER PEX TUBE (SDR 9) (CLOSED PIPING SYSTEM).
 4. MINIMUM 5/8" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT.
 5. MINIMUM 1/2" BEAD HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 5".
 2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1".

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000 Sheet 1 of 1 Scale 3/16" = 1" Drawing No. WL 2467b Date Jan. 12, 2015

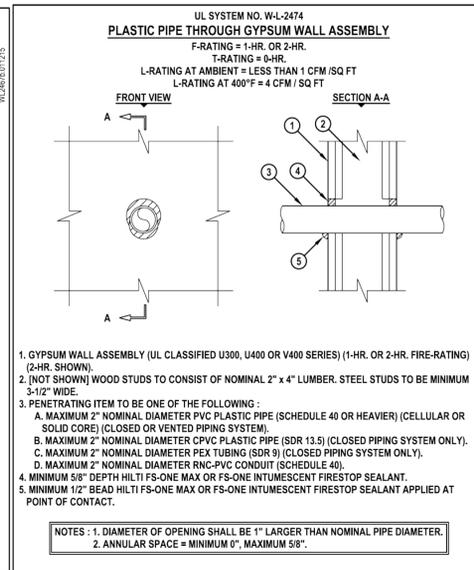


UL SYSTEM NO. W-1-2474
PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 0-HR.
 L-RATING AT AMBIENT = LESS THAN 1 CFM / SQ FT
 L-RATING AT 400°F = 4 CFM / SQ FT

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300, U400 OR V400 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. (NOT SHOWN) WOOD STUDS TO CONSIST OF NOMINAL 2" x 4" LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.
 3. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:
 A. MAXIMUM 2" NOMINAL DIAMETER PVC PLASTIC PIPE (SCHEDULE 40 OR HEAVIER) (CELLULAR OR SOLID CORE) (CLOSED OR VENTED PIPING SYSTEM).
 B. MAXIMUM 2" NOMINAL DIAMETER CPVC PLASTIC PIPE (SDR 13.5) (CLOSED PIPING SYSTEM ONLY).
 C. MAXIMUM 2" NOMINAL DIAMETER PEX TUBING (SDR 9) (CLOSED PIPING SYSTEM ONLY).
 D. MAXIMUM 2" NOMINAL DIAMETER RNC-PVC CONDUIT (SCHEDULE 40).
 4. MINIMUM 5/8" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT.
 5. MINIMUM 1/2" BEAD HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT.

NOTES: 1. DIAMETER OF OPENING SHALL BE 1" LARGER THAN NOMINAL PIPE DIAMETER.
 2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 5/8".

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000 Sheet 1 of 1 Scale 3/16" = 1" Drawing No. WL 2474d Date Jan. 12, 2015

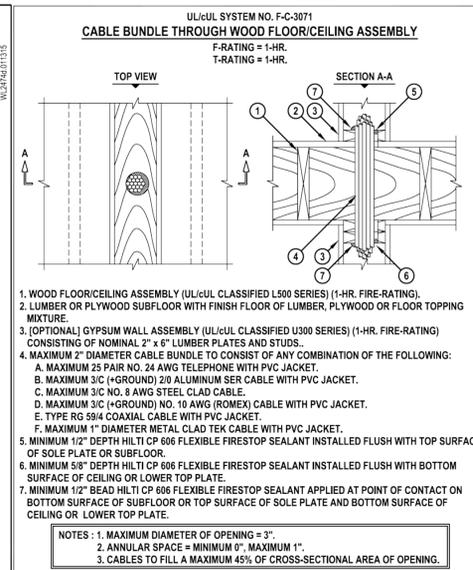


UL SYSTEM NO. F-C-3071
CABLE BUNDLE THROUGH WOOD FLOOR/CEILING ASSEMBLY
 F-RATING = 1-HR.
 T-RATING = 1-HR.

1. WOOD FLOOR/CEILING ASSEMBLY (UL/ULC CLASSIFIED L500 SERIES) (1-HR. FIRE-RATING).
 2. LUMBER OR PLYWOOD SUBFLOOR WITH FINISH FLOOR OF LUMBER, PLYWOOD OR FLOOR TOPPING MIXTURE.
 3. (OPTIONAL) GYPSUM WALL ASSEMBLY (UL/ULC CLASSIFIED U300 SERIES) (1-HR. FIRE-RATING) CONSISTING OF NOMINAL 2" x 4" LUMBER PLATES AND STUDS.
 4. MAXIMUM 2" DIAMETER CABLE BUNDLE TO CONSIST OF ANY COMBINATION OF THE FOLLOWING:
 A. MAXIMUM 25 PAIR NO. 12 AWG TELEPHONE CABLE WITH PVC JACKET.
 B. MAXIMUM 3" (+GROUND) 20 AWG ALUMINUM SER CABLE WITH PVC JACKET.
 C. MAXIMUM 3/8" NO. 8 AWG STEEL CLAD CABLE.
 D. MAXIMUM 3/8" (+GROUND) NO. 10 AWG (ROMEX) CABLE WITH PVC JACKET.
 E. TYPE RG 59/4 COAXIAL CABLE WITH PVC JACKET.
 F. MAXIMUM 1" DIAMETER METAL CLAD TEK CABLE WITH PVC JACKET.
 5. MINIMUM 1/2" DEPTH HILTI CP 606 FLEXIBLE FIRESTOP SEALANT INSTALLED FLUSH WITH TOP SURFACE OF SOLE PLATE OR SUBFLOOR.
 6. MINIMUM 3/4" DEPTH HILTI CP 606 FLEXIBLE FIRESTOP SEALANT INSTALLED FLUSH WITH BOTTOM SURFACE OF CEILING OR LOWER TOP PLATE.
 7. MINIMUM 1/2" BEAD HILTI CP 606 FLEXIBLE FIRESTOP SEALANT APPLIED AT POINT OF CONTACT ON BOTTOM SURFACE OF SUBFLOOR OR TOP SURFACE OF SOLE PLATE AND BOTTOM SURFACE OF CEILING OR LOWER TOP PLATE.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 3".
 2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1".
 3. CABLES TO FILL A MAXIMUM 45% OF CROSS-SECTIONAL AREA OF OPENING.

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000 Sheet 1 of 1 Scale 1/8" = 1" Drawing No. FC 3071d Date Sep. 27, 2007

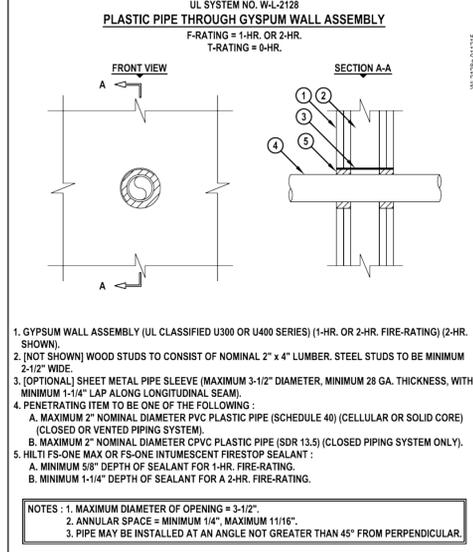


UL SYSTEM NO. W-1-2128
PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 0-HR.

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 OR U400 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. (NOT SHOWN) WOOD STUDS TO CONSIST OF NOMINAL 2" x 4" LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.
 3. (OPTIONAL) SHEET METAL PIPE SLEEVE (MAXIMUM 3-1/2" DIAMETER, MINIMUM 28 GA. THICKNESS, WITH MINIMUM 1-1/4" LAP ALONG LONGITUDINAL SEAM).
 4. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:
 A. MAXIMUM 2" NOMINAL DIAMETER CPVC PLASTIC PIPE (SCHEDULE 40) (CELLULAR OR SOLID CORE) (CLOSED OR VENTED PIPING SYSTEM).
 B. MAXIMUM 2" NOMINAL DIAMETER CROSS-LINKED POLYETHYLENE (PEX) SDR 9 TUBING (CLOSED OR VENTED PIPING SYSTEM) (MAXIMUM QUANTITY = 3).
 5. MINIMUM 3/4" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT FLUSH WITH TOP SURFACE OF FLOOR OR SOLE PLATE.
 6. MINIMUM 5/8" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT FLUSH WITH BOTTOM SURFACE OF CEILING OR LOWER TOP PLATE.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 3-1/2".
 2. ANNULAR SPACE = MINIMUM 1/4", MAXIMUM 11/16".
 3. PIPE MAY BE INSTALLED AT AN ANGLE NOT GREATER THAN 45° FROM PERPENDICULAR.

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000 Sheet 1 of 1 Scale 3/16" = 1" Drawing No. WL 2128g Date Jan. 12, 2015

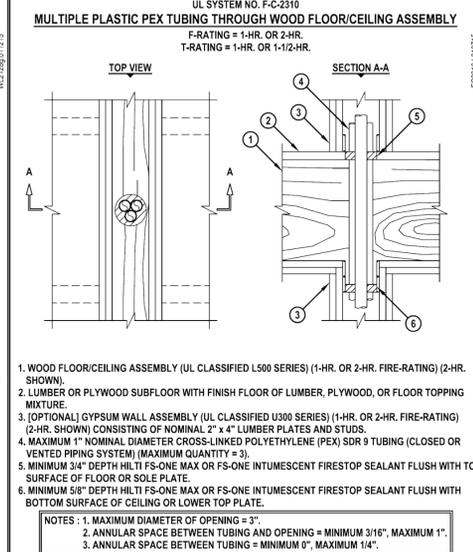


UL SYSTEM NO. F-C-2310
MULTIPLE PLASTIC PEX TUBING THROUGH WOOD FLOOR/CEILING ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 1-HR. OR 1-1/2-HR.

1. WOOD FLOOR/CEILING ASSEMBLY (UL CLASSIFIED L500 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. LUMBER OR PLYWOOD SUBFLOOR WITH FINISH FLOOR OF LUMBER, PLYWOOD, OR FLOOR TOPPING MIXTURE.
 3. (OPTIONAL) GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN) CONSISTING OF NOMINAL 2" x 4" LUMBER PLATES AND STUDS.
 4. MAXIMUM 1" NOMINAL DIAMETER CROSS-LINKED POLYETHYLENE (PEX) SDR 9 TUBING (CLOSED OR VENTED PIPING SYSTEM) (MAXIMUM QUANTITY = 3).
 5. MINIMUM 3/4" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT FLUSH WITH TOP SURFACE OF FLOOR OR SOLE PLATE.
 6. MINIMUM 5/8" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT FLUSH WITH BOTTOM SURFACE OF CEILING OR LOWER TOP PLATE.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 3".
 2. ANNULAR SPACE BETWEEN TUBING AND OPENING = MINIMUM 3/16", MAXIMUM 1".
 3. ANNULAR SPACE BETWEEN TUBING = MINIMUM 0", MAXIMUM 1/4".

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000 Sheet 1 of 1 Scale 1/16" = 1" Drawing No. FC 2310d Date Jan. 07, 2015

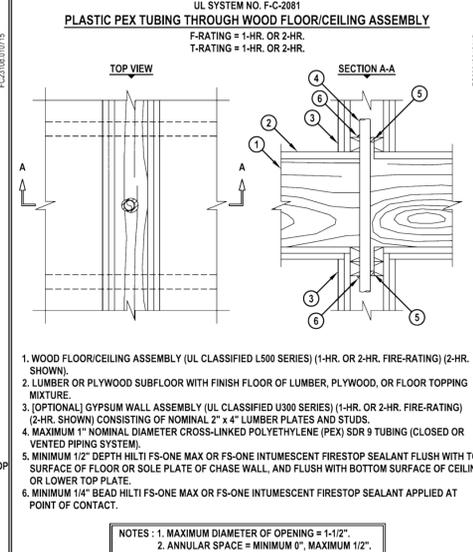

UL SYSTEM NO. F-C-2081
PLASTIC PEX TUBING THROUGH WOOD FLOOR/CEILING ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 1-HR. OR 2-HR.

1. WOOD FLOOR/CEILING ASSEMBLY (UL CLASSIFIED L500 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. LUMBER OR PLYWOOD SUBFLOOR WITH FINISH FLOOR OF LUMBER, PLYWOOD, OR FLOOR TOPPING MIXTURE.
 3. (OPTIONAL) GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN) CONSISTING OF NOMINAL 2" x 4" LUMBER PLATES AND STUDS.
 4. MAXIMUM 1" NOMINAL DIAMETER CROSS-LINKED POLYETHYLENE (PEX) SDR 9 TUBING (CLOSED OR VENTED PIPING SYSTEM).
 5. MINIMUM 1/2" DEPTH HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT FLUSH WITH TOP SURFACE OF FLOOR OR SOLE PLATE, AND FLUSH WITH BOTTOM SURFACE OF CEILING OR LOWER TOP PLATE.
 6. MINIMUM 1/4" BEAD HILTI FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT.


NOTES: 1. MAXIMUM DIAMETER OF OPENING = 1-1/2".
 2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1/2".

Hilti Firestop Systems HILTI, Inc. Tulsa, Oklahoma USA (800) 879-8000 Sheet 1 of 1 Scale 3/16" = 1" Drawing No. FC 2081f Date Jan. 24, 2015

TYPE OF PENETRANT	F-RATING (HR)	BASIS OF DESIGN UL SYSTEM				Hilti Products
		CONCRETE FLOORS	CONCRETE OR BLOCK WALLS	GYPSUM WALLS	WOOD FLOORS	
CIRCULAR BLANK OPENINGS	1	F-A-0006, C-AJ-0055, C-AJ-0090	C-AJ-0055, C-AJ-0090			CP 680, CP 618, FS One Max, Firestop Block (CFS-Bl)
	2	F-A-0006, C-AJ-0055, C-AJ-0090	C-AJ-0055, C-AJ-0090			
	3	F-A-0006, C-AJ-0055, C-AJ-0090, F-A-0014	C-AJ-0055, C-AJ-0090			
METAL PIPES OR CONDUIT	1	C-AJ-1226, F-A-1028, F-A-1017	C-AJ-1226, W-J-1067, W-J-1020			F-C-1009, F-C-1059, F-C-1168
	2	C-AJ-1226, F-A-1028, F-A-1017	C-AJ-1226, W-J-1067, W-J-1020, W-J-1248			F-C-1009, F-C-1059, F-C-1168
	3	C-AJ-1226, F-A-1017	C-AJ-1226, W-J-1041, W-J-1068			
	4	C-BJ-1037, C-BJ-1034	C-BJ-1034, C-BJ-1037, W-J-1041, W-J-1042, W-J-1068			
NON-METALLIC PIPE OR CONDUIT (E.P.V.C., CPVC, ABS, FRP, ENT)	1	F-A-2053, F-A-2025, C-AJ-2109, C-AJ-2098, C-AJ-2271, C-AJ-2167, C-BJ-2021, C-AJ-2342	C-AJ-2109, C-AJ-2098, C-AJ-2167, C-AJ-2342			F-C-2232, F-C-2030, F-C-2160, F-C-2389
	2	F-A-2053, F-A-2025, C-AJ-2109, C-AJ-2098, C-AJ-2271, C-AJ-2167, C-BJ-2021, C-AJ-2342	C-AJ-2109, C-AJ-2098, C-AJ-2167, C-AJ-2342			F-C-2020, F-C-2030, F-C-2128, C-2189
	3	F-A-2054, C-AJ-2109, C-AJ-2098, C-AJ-2371, C-AJ-2342	C-AJ-2109, C-AJ-2098, C-AJ-2371, C-AJ-2342			
	4	C-BJ-2016, C-AJ-2017	W-J-2057, W-J-2091			
SINGLE OR BUNDLED CABLES	1	F-A-3007, C-AJ-3095, C-AJ-3180, C-AJ-3283	W-J-3036, C-AJ-3095, C-AJ-3180, W-J-3167			W-L-3065, W-L-3111, W-L-3112, W-L-3334, W-L-3414, W-L-3399
	2	F-A-3007, C-AJ-3095, C-AJ-3334, F-A-3060	W-J-3036, C-AJ-3095, C-AJ-3180, W-J-3060, W-J-3167, W-L-3189			F-C-3012, F-C-3110
	3	F-A-3007, C-AJ-3095, C-AJ-3285	C-AJ-3095, C-AJ-3180, W-J-3167			
	4	N/A**	W-J-3050			
CABLE TRAY	1	C-AJ-4034, C-AJ-4035	W-J-4027, C-AJ-4034, C-AJ-4035			W-L-3139, W-L-3334
	2	C-AJ-4034, C-AJ-4035	W-J-4027, C-AJ-4034, C-AJ-4035			W-L-4011, W-L-4019, W-L-4081
	3	C-AJ-4034, C-AJ-4035	W-L-3385, C-AJ-4035			W-L-3385, W-L-3277
	4	N/A**	W-J-8007			W-L-8014
INSULATED PIPES	1	F-A-5015, F-A-5017, C-AJ-5050, C-AJ-5091, C-AJ-5050, C-AJ-5048	C-AJ-5090, C-AJ-5091, C-AJ-5061, W-J-5047			W-L-5029, W-L-5029, W-L-5047
	2	F-A-5015, F-A-5017, C-AJ-5090, C-AJ-5091, C-AJ-5090	C-AJ-5090, C-AJ-5091, C-AJ-5061, W-J-5047			F-C-5004, F-C-5037
	3	F-A-5016, C-AJ-5090, F-A-5016	C-AJ-5090, C-AJ-5091			
	4	C-BJ-5006	C-BJ-5006, W-J-5028			W-L-5073
ELECTRICAL BUSWAY	1	C-AJ-6036, C-AJ-6017, F-A-6042, C-AJ-6036	C-AJ-6036, C-AJ-6017, C-AJ-6036			
	2	C-AJ-6036, C-AJ-6017, F-A-6042, C-AJ-6036	C-AJ-6036, C-AJ-6017, C-AJ-6036			
	3	C-AJ-6036, C-AJ-6017	C-AJ-6036, C-AJ-6017			
MECHANICAL DUCTWORK WITHOUT DAMPERS (NON-INSULATED)	1	C-AJ-7046, C-AJ-7051, C-AJ-7094	C-AJ-7046, C-AJ-7051, W-J-7021, W-J-7022			W-L-7017, W-L-7040, W-L-7042, W-L-7155
	2	C-AJ-7046, C-AJ-7051, C-AJ-7085	C-AJ-7046, C-AJ-7051, W-J-7021, W-J-7022			W-L-7040, W-L-7042, W-L-7155
	3	C-AJ-7046, C-AJ-7051	C-AJ-7046, C-AJ-7051			
MECHANICAL DUCTWORK WITHOUT DAMPERS (INSULATED)	1	N/A**	W-J-7029, W-J-7124			W-L-7059, W-L-7153, W-L-7156, W-L-7151
	2	N/A**	W-J-7091, W-J-7112, W-J-7124			W-L-7059, W-L-7153, W-L-7156, W-L-7151
	3	C-AJ-8099, C-AJ-8056, C-AJ-8143	C-AJ-8099, C-AJ-8056, W-J-8007, C-AJ-8143			W-L-1095, W-L-1013
MIXED PENETRANTS	1	C-AJ-8099, C-AJ-8056, C-AJ-8143	C-AJ-8099, C-AJ-8056, W-J-8007, C-AJ-8143			F-C-8009, F-C-8014, F-C-8026
	2	C-AJ-8099, C-AJ-8056, C-AJ-8143	C-AJ-8099, C-AJ-8056, W-J-8007, C-AJ-8143			W-L-1095, W-L-1013
	3	C-AJ-8099, C-AJ-8056	C-AJ-8041, C-AJ-8056, W-J-8007, C-AJ-8099			
4	C-AJ-8095				W-L-8014	

*CONTACT HILTI FOR CURRENT UL CLASSIFIED SYSTEM OR ENGINEER JUDGMENT DRAWING: 800-879-8000

NOTES:
 1. Install conditions of each through-penetration firestop system must meet all details of the UL Classified system selected.
 2. If gasket conditions do not match any UL classified systems in the schedules above, contact Hilti for alternative systems or Engineer Judgment Drawings - 800-879-8000
 3. Where more than one applicable UL Classified System is listed in the schedules, choose the UL System which is most economical for each through-penetration firestop system.
 4. Coordinate work with other trades to assure that penetration opening sizes are appropriate for penetrant locations, and vice versa.

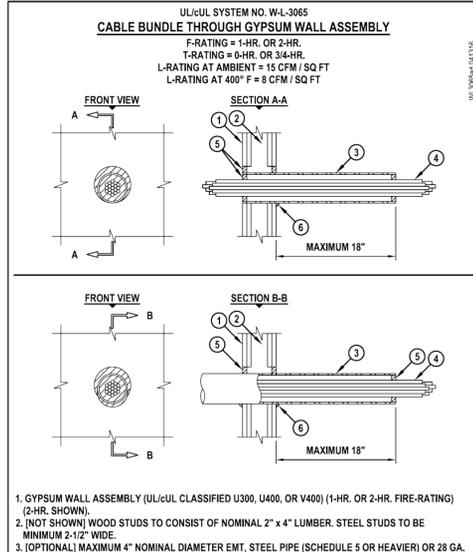


UL SYSTEM NO. W-1-3065
CABLE BUNDLE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 0-HR. OR 3/4-HR.
 L-RATING AT AMBIENT = 15 CFM / SQ FT
 L-RATING AT 400°F = 8 CFM / SQ FT

1. GYPSUM WALL ASSEMBLY (UL/ULC CLASSIFIED U300, U400, OR V400) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
 2. (NOT SHOWN) WOOD STUDS TO CONSIST OF NOMINAL 2" x 4" LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.
 3. (OPTIONAL) MAXIMUM 4" NOMINAL DIAMETER ENT, STEEL PIPE (SCHEDULE 5 OR HEAVIER) OR 28 GA. GALVANIZED STEEL SLEEVE (SEE NOTE NO. 6 BELOW).

NOTES: 1. MAXIMUM DIAMETER OF OPENING WITH SLEEVE = 5-1/2".
 2. MAXIMUM DIAMETER OF OPENING WITHOUT SLEEVE = 4".
 3. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1".
 4. A MINIMUM 1/8" SEPARATION SHOULD BE MAINTAINED BETWEEN MI CABLES AND ANY OTHER TYPES OF CABLE.
 5. CABLES TO FILL MAXIMUM 45% OF CROSS-SECTIONAL AREA OF OPENING.
 6. WHEN SCHEDULE 5 STEEL PIPE OR ENT IS USED, OPEN ENDED SLEEVE MAY EXTEND UP TO 18" BEYOND WALL SURFACE. AS AN OPTION, SCHEDULE 5 STEEL PIPE OR ENT SLEEVE MAY EXTEND CONTINUOUSLY BEYOND ONE WALL SURFACE.
 7. WHEN SLEEVE IS CONTINUOUS ON ONE SIDE OF WALL, THE CABLE FILL MAY BE 0% TO 45% AND THE MAXIMUM ANNULAR SPACE IS NOT LIMITED.
 8. (OPTIONAL - NOT SHOWN) MINERAL WOOL (MIN. 4 PCF DENSITY) TIGHTLY PACKED AND RECESSED TO ACCOMMODATE FIRESTOP SEALANT OR PUTTY MAY BE USED AS BACKING MATERIAL.

Hilti Firestop Systems HILTI, Inc. Plano, Texas USA (800) 879-8000 Sheet 1 of 2 Scale 7/8" = 1" Drawing No. WL 3065ad Date Apr. 13, 2016

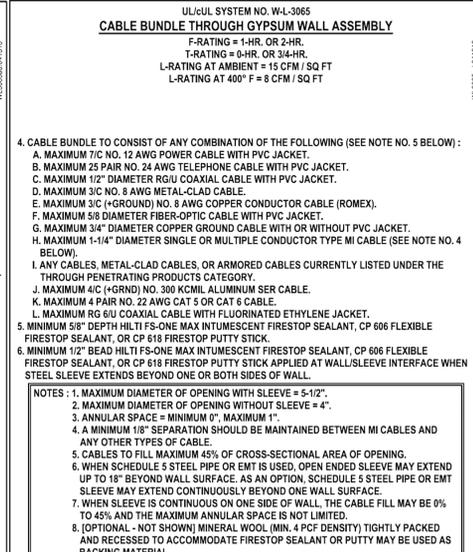


UL SYSTEM NO. W-1-3065
CABLE BUNDLE THROUGH GYPSUM WALL ASSEMBLY
 F-RATING = 1-HR. OR 2-HR.
 T-RATING = 0-HR. OR 3/4-HR.
 L-RATING AT AMBIENT = 15 CFM / SQ FT
 L-RATING AT 400°F = 8 CFM / SQ FT

4. CABLE BUNDLE TO CONSIST OF ANY COMBINATION OF THE FOLLOWING (SEE NOTE NO. 5 BELOW):
 A. MAXIMUM 7/8" NO. 12 AWG POWER CABLE WITH PVC JACKET.
 B. MAXIMUM 25 PAIR NO. 24 AWG TELEPHONE CABLE WITH PVC JACKET.
 C. MAXIMUM 1/2" DIAMETER RGU COAXIAL CABLE WITH PVC JACKET.
 D. MAXIMUM 3/8" NO. 8 AWG METAL-CLAD CABLE.
 E. MAXIMUM 3/8" (+GROUND) NO. 8 AWG COPPER CONDUCTOR CABLE (ROMEX).
 F. MAXIMUM 5/8" DIAMETER FIBER-OPTIC CABLE WITH PVC JACKET.
 G. MAXIMUM 3/4" DIAMETER COPPER GROUND CABLE WITH OR WITHOUT PVC JACKET.
 H. MAXIMUM 1-1/4" DIAMETER SINGLE OR MULTIPLE CONDUCTOR TYPE MI CABLE (SEE NOTE NO. 4 BELOW).
 I. ANY CABLES, METAL-CLAD CABLES, OR ARMORED CABLES CURRENTLY LISTED UNDER THE THROUGH PENETRATING PRODUCTS CATEGORY.
 J. MAXIMUM 4/8" (+GROUND) NO. 300 KVMIL ALUMINUM SER CABLE.
 K. MAXIMUM 4 PAIR NO. 22 AWG CAT 5 OR CAT 6 CABLE.
 L. MAXIMUM RG 6/U COAXIAL CABLE WITH FLUORINATED ETHYLENE JACKET.
 5. MINIMUM 5/8" DEPTH HILTI FS-ONE MAX INTUMESCENT FIRESTOP SEALANT, CP 606 FLEXIBLE FIRESTOP SEALANT, OR CP 618 FIRESTOP PUTTY STICK.
 6. MINIMUM 1/2" BEAD HILTI FS-ONE MAX INTUMESCENT FIRESTOP SEALANT, CP 606 FLEXIBLE FIRESTOP SEALANT, OR CP 618 FIRESTOP PUTTY STICK APPLIED AT WALL/SLEEVE INTERFACE WHEN STEEL SLEEVE EXTENDS BEYOND ONE OR BOTH SIDES OF WALL.

NOTES: 1. MAXIMUM DIAMETER OF OPENING WITH SLEEVE = 5-1/2".
 2. MAXIMUM DIAMETER OF OPENING WITHOUT SLEEVE = 4".
 3. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1".
 4. A MINIMUM 1/8" SEPARATION SHOULD BE MAINTAINED BETWEEN MI CABLES AND ANY OTHER TYPES OF CABLE.
 5. CABLES TO FILL MAXIMUM 45% OF CROSS-SECTIONAL AREA OF OPENING.
 6. WHEN SCHEDULE 5 STEEL PIPE OR ENT IS USED, OPEN ENDED SLEEVE MAY EXTEND UP TO 18" BEYOND WALL SURFACE. AS AN OPTION, SCHEDULE 5 STEEL PIPE OR ENT SLEEVE MAY EXTEND CONTINUOUSLY BEYOND ONE WALL SURFACE.
 7. WHEN SLEEVE IS CONTINUOUS ON ONE SIDE OF WALL, THE CABLE FILL MAY BE 0% TO 45% AND THE MAXIMUM ANNULAR SPACE IS NOT LIMITED.
 8. (OPTIONAL - NOT SHOWN) MINERAL WOOL (MIN. 4 PCF DENSITY) TIGHTLY PACKED AND RECESSED TO ACCOMMODATE FIRESTOP SEALANT OR PUTTY MAY BE USED AS BACKING MATERIAL.

Hilti Firestop Systems HILTI, Inc. Plano, Texas USA (800) 879-8000 Sheet 2 of 2 Scale 7/8" = 1" Drawing No. WL 3065ad Date Apr. 13, 2016

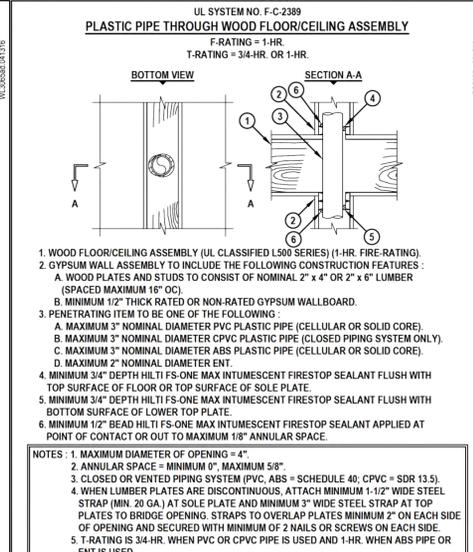

UL SYSTEM NO. F-C-2389
PLASTIC PIPE THROUGH WOOD FLOOR/CEILING ASSEMBLY
 F-RATING = 1-HR.
 T-RATING = 3/4-HR. OR 1-HR.

1. WOOD FLOOR/CEILING ASSEMBLY (UL CLASSIFIED L500 SERIES) (1-HR. FIRE-RATING).
 2. GYPSUM WALL ASSEMBLY TO INCLUDE THE FOLLOWING CONSTRUCTION FEATURES:

DESIGN CRITERIA

BUILDING CODE: 2018 INTERNATIONAL BUILDING CODE (IBC) AS AMENDED BY THE LOCAL JURISDICTION.

VERTICAL LOADS

ROOF LIVE LOAD:	25 PSF (SNOW)
ROOF DEAD LOAD:	25 PSF
RESIDENTIAL FLOOR LIVE LOAD:	40 PSF (REDUCIBLE) : 60 PSF (FOR DECKS)
STAIRWAY LANDING AREAS:	150 PSF (INCLUDING $l_p=1.5$)
FLOOR DEAD LOAD:	30 PSF (INCLUDES 1 1/2" GYP TOPPING)
SNOW DESIGN DATA (ASCE 7-16)	WIND DESIGN DATA (ASCE 7-16)
FLAT SNOW LOAD: N/A	BASIC WIND SPEED (ASD) V= 85MPH
SNOW EXPOSURE FACTOR, $C_e=1.0$,	ULTIMATE WIND SPEED V= 110MPH
SNOW IMPORTANCE FACTOR, $I_s=1.0$,	RISK CATEGORY: II EXPOSURE: B
THERMAL FACTOR, $C_t=1.1$	IMPORTANCE FACTOR, $I_w= 1.0$
	TOPOGRAPHIC FACTOR, $K_{zt}= 1.0$

SEISMIC DESIGN DATA (ASCE7-16)
 SEISMIC RESPONSE SYSTEM: WOOD SHEARWALLS
 EQUIVALENT LATERAL FORCE PROCEDURE (ASCE 7-16)
 RISK CATEGORY: II SEISMIC IMPORTANCE FACTOR, $I_e= 1.0$
 MAPPED SPECTRAL RESPONSE ACCELERATION: $S_s=1.24$, $S_1=0.476$
 DESIGN SPECTRAL RESPONSE ACCELERATION: $S_{ds}=0.831$, $S_{d1}=0.476$
 SITE CLASS: D SEISMIC DESIGN CATEGORY: D
 SEISMIC RESPONSE COEFFICIENT: $C_s= 0.091$
 DESIGN BASE SHEAR: 37,932#
 SOIL PROPERTIES:
 BEARING CAPACITY: 2,000 PSF
 LATERAL CAPACITY: 250 PSF/FT

GENERAL REQUIREMENTS

- STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH THE SPECIFICATIONS AND OTHER PROJECT DRAWINGS BY OTHER DISCIPLINES. ALL WORK SHALL CONFORM TO THE REQUIREMENTS OF THE CODES LISTED ABOVE.
- CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND ELEVATIONS RELATING TO EXISTING CONDITIONS BY MAKING FIELD SURVEYS AND MEASUREMENTS PRIOR TO COMMENCING FABRICATION OR CONSTRUCTION.
- THE GENERAL CONTRACTOR SHALL ENSURE THAT ALL CONSTRUCTION METHODS USED WILL NOT CAUSE DAMAGE TO ADJACENT BUILDINGS, UTILITIES, OR OTHER PROPERTY. THIS REQUIREMENT IS PARTICULARLY IMPORTANT DURING FOUNDATION INSTALLATION.
- THE GENERAL CONTRACTOR IS ADVISED TO CONSIDER PERFORMING PHOTOGRAPHIC SURVEYS AND OTHER DOCUMENTATION OF THE CONDITION OF ADJACENT BUILDINGS AND OTHER STRUCTURES BEFORE THE START OF CONSTRUCTION.
- THE GENERAL CONTRACTOR SHALL OBTAIN COPIES OF THE LATEST CONTRACT DOCUMENTS, INCLUDING ALL ADDENDA, AND PROVIDE THE RELEVANT PORTIONS TO ALL SUB-CONTRACTORS AND SUPPLIERS PRIOR TO SUBMITTAL OF SHOP DRAWINGS AND FABRICATION AND ERECTION OF STRUCTURAL MEMBERS.
- THE GENERAL CONTRACTOR SHALL COMPARE AND COORDINATE THE DRAWINGS OF ALL DISCIPLINES AND REPORT ANY DISCREPANCIES BETWEEN THE DRAWINGS TO THE ARCHITECT AND ENGINEER.
- DETAILS LABELED "TYPICAL" SHALL APPLY TO ALL SITUATIONS THAT ARE THE SAME OR SIMILAR TO THOSE SPECIFICALLY DETAILED. SEE DETAIL TITLES FOR APPLICABILITY OF A PARTICULAR DETAIL. TYPICAL DETAILS SHALL APPLY WHETHER OR NOT THEY ARE SPECIFICALLY KEVED AT EACH LOCATION. THE ENGINEER SHALL HAVE FINAL AUTHORITY TO DETERMINE APPLICABILITY OF TYPICAL DETAILS.
- WHERE CONFLICTS EXIST BETWEEN STRUCTURAL DOCUMENTS THE STRICTEST REQUIREMENTS, AS INDICATED BY THE STRUCTURAL ENGINEER SHALL GOVERN.
- THE GENERAL CONTRACTOR SHALL REVIEW AND DETERMINE THAT DIMENSIONS ARE COORDINATED BETWEEN ARCHITECTURAL AND STRUCTURAL DRAWINGS PRIOR TO FABRICATION OR START OF CONSTRUCTION.
- NO STRUCTURAL MEMBER SHALL BE CUT OR NOTCHED OR OTHERWISE REDUCED IN STRENGTH UNLESS APPROVED BY THE STRUCTURAL ENGINEER.
- THE GENERAL CONTRACTOR SHALL COORDINATE ARCHITECTURAL, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR ANCHORED, EMBEDDED OR SUPPORTED ITEMS. NOTIFY THE ARCHITECT / ENGINEER OF ANY DISCREPANCIES.

CONSTRUCTION RESPONSIBILITY

- THE CONTRACT STRUCTURAL DRAWINGS AND SPECIFICATIONS REPRESENT THE COMPLETED STRUCTURE, AND ARE NOT INTENDED TO INDICATE THE METHOD OR MEANS OF CONSTRUCTION. THE CONTRACTOR SHALL SUPERVISE AND DIRECT THE WORK AND SHALL BE SOLELY RESPONSIBLE FOR ALL CONSTRUCTION MEANS, METHODS, PROCEDURES, TECHNIQUES, SEQUENCES, AND FOR JOB SAFETY.
- THE ENGINEER DOES NOT HAVE CONTROL OR CHARGE OF, AND SHALL NOT BE RESPONSIBLE FOR, CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, OR PROCEDURES, FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK, FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, SUBCONTRACTOR, OR ANY OTHER PERSONS PERFORMING ANY OF THE WORK, OR FOR THE FAILURE OF ANY OF THEM TO CARRY OUT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
- PERIODIC SITE OBSERVATION VISITS MAY BE PROVIDED BY THE STRUCTURAL ENGINEER. THE SOLE PURPOSE OF THESE OBSERVATIONS IS TO REVIEW THE GENERAL CONFORMANCE OF THE CONSTRUCTION WITH THE STRUCTURAL CONTRACT DOCUMENTS. THESE LIMITED OBSERVATIONS SHOULD NOT BE CONSTRUED AS CONTINUOUS OR EXHAUSTIVE TO VERIFY THAT ALL CONSTRUCTION IS IN COMPLIANCE WITH THE CONSTRUCTION DOCUMENTS. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR PERFORMING ALL WORK IN COMPLIANCE WITH THE CONSTRUCTION DOCUMENTS.

ABBREVIATIONS

A.F.F.	ABOVE FINISHED FLOOR	N.T.S.	NOT TO SCALE
CLR.	CLEAR	O.C.	ON CENTER
☐	CENTERLINE	PT	PRESSURE TREATED
CONC.	CONCRETE	REINF.	REINFORCEMENT
CONT.	CONTINUOUS	SIM	SIMILAR
C.J.	CONTROL JOINT	SF	SQUARE FEET
E.W.	EACH WAY	S.O.G.	SLAB ON GRADE
GLB	GLULAM BEAM	STL.	STEEL
LBW	LOAD BEARING WALL	T&G	TONGUE AND GROOVE
HD	HOLD DOWN	TYP.	TYPICAL
MFR.	MANUFACTURER	U.N.O.	UNLESS NOTED OTHERWISE
MIN.	MINIMUM	W/	WITH
MTL.	METAL		
N.T.S.	NOT TO SCALE		

DEFERRED SUBMITTALS

THE FOLLOWING IS A LIST OF ITEMS THAT ARE NOT INCLUDED IN THIS PLAN AND SHOULD BE PROVIDED BY THE BUILDER AT TIME OF APPLICATION FOR PERMIT OR AS A DEFERRED SUBMITTAL ITEM:

- ALTERNATIVE I-JOIST/BEAM MANUFACTURER PLANS
- PRE-ENGINEERED TRUSS DESIGNS AND LAYOUTS

SITE WORK

PER KRAZAN & ASSOCIATES, INC. REPORT DATED APRIL 11, 2019, FOUNDATION DESIGN IS BASED ON AN ASSUMED AVERAGE SOIL BEARING OF 2,000 PSF. EXTERIOR FOOTINGS SHALL BEAR 18" & INTERIOR FOOTINGS SHALL BEAR 12" (MINIMUM) BELOW FINISHED GRADE. ALL FOOTINGS TO BEAR ON FIRM UNDISTURBED EARTH BELOW ORGANIC SURFACE SOILS OR ON STRUCTURAL FILL PER THE GEOTECHS RECOMMENDATIONS.

CONCRETE

ITEM	DESIGN f'_c (PSI)	MAX. W/C RATIO	MAX. AGGREGATE SIZE	MIN. CEMENT (SACKS/YARD)
FOUNDATIONS	2,500 @28 DAYS	0.45	3"	
STEM WALLS	3,000 @28 DAYS	0.45	3"	
SLAB ON GRADE	3,000 @28 DAYS	0.45	3"	

- REINFORCING STEEL SHALL BE ASTM A615 GRADE 40 FOR #4 BARS AND SMALLER AND GRADE 60 FOR #5 BARS AND LARGER.
- MINIMUM SPLICE LENGTHS SHALL BE: 24" FOR #4, 30" FOR #5, 42" FOR #6
- CONCRETE COVER SHALL BE: 3" CAST AGAINST EARTH, 2" EXPOSED TO EARTH/WEATHER, 3/4" NOT EXPOSED TO EARTH/WEATHER.
- CORNER BARS ARE REQUIRED FOR ALL HORIZONTAL BARS IN FOOTINGS AND WALLS.
- ALL CONCRETE HAS BEEN DESIGNED FOR 2,500 PSI CONCRETE SO NO SPECIAL INSPECTION IS REQUIRED.

FRAMING

- ALL NAILING TO COMPLY WITH REQUIREMENTS OF IBC 2303.6 AND FASTENED PER TABLE 2304.10.1.
- ALL WOOD IN CONTACT WITH CONCRETE TO BE PRESSURE TREATED. FIELD CUT ENDS, NOTCHES, AND DRILLED HOLES OF PRESSURE TREATED LUMBER SHALL BE RETREATED IN THE FIELD IN ACCORDANCE WITH AWPA M4.
- FASTENERS FOR PRESSURE PRESERVATIVE AND FIRE RETARDANT TREATED WOOD SHALL BE OF HOT-DIPPED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE OR COPPER.
- MAINTAIN 8" MINIMUM CLEARANCE BETWEEN WOOD AND EARTH.
- MAINTAIN 12" MINIMUM CLEARANCE BETWEEN FLOOR BEAMS AND EARTH.
- MAINTAIN 18" MINIMUM CLEARANCE BETWEEN FLOOR JOISTS AND EARTH.

LUMBER GRADES

FRAMING LUMBER SHALL COMPLY WITH THE LATEST EDITION OF THE GRADING RULES OF THE WESTERN PRODUCTS ASSOCIATION OR THE WEST COAST LUMBER INSPECTION BUREAU. ALL SAWN LUMBER SHALL BE STAMPED WITH THE GRADE MARK OF AN APPROVED LUMBER GRADING AGENCY AND SHALL HAVE THE FOLLOWING UNADJUSTED DESIGN MINIMUM PROPERTIES:

JOISTS:	WOOD TYPE:
2X4	HF #2 - Fb=850 PSI, FV=75 PSI, Fc=1300 PSI, E=1200000 PSI
2X6 OR LARGER	HF #2 - Fb=850 PSI, Fv=75 PSI, Fc=1300 PSI, E=1200000 PSI
BEAMS:	WOOD TYPE:
4X	DF-L#2 - Fb=900 PSI, FV=95 PSI, Fc=1350 PSI, E=1600000 PSI
6X OR LARGER	DF-L #2 - Fb=875 PSI, Fv=85 PSI, Fc=600 PSI, E=1300000 PSI
STUDS:	WOOD TYPE:
2X4	HF #2 - Fb=850 PSI, FV=75 PSI, Fc=1300 PSI, E=1200000 PSI
2X6 OR LARGER	HF #2 - Fb=850 PSI, Fv=75 PSI, Fc=1300 PSI, E=1200000 PSI
POSTS:	WOOD TYPE:
4X4	HF #2 - Fb=900 PSI, FV=95 PSI, Fc=1350 PSI, E=1600000 PSI
4X6 OR LARGER	HF #2 - Fb=900 PSI, FV=95 PSI, Fc=1350 PSI, E=1600000 PSI
6X6 OR LARGER	DF-L #1 - Fb=700 PSI, FV=85 PSI, Fc=475 PSI, E=1300000 PSI
6X6 OR LARGER	DF-L #2 - Fb=700 PSI, FV=85 PSI, Fc=475 PSI, E=1300000 PSI

FASTENERS

ALL NAILS SPECIFIED ON THIS PLAN SHALL BE COMMON OR GALVANIZED BOX (UNLESS NOTED OTHERWISE) OF THE DIAMETER AND LENGTH LISTED BELOW OR AS PER APPENDIX L OF THE NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION (NDS). ALL FASTENERS PLACE IN PRESSURE TREATED OR FIRE TREATED LUMBER/SHEATHING SHALL BE GALVANIZED.

- 8D COMMON (0.131" DIA., 2-1/2" LENGTH)
- 8D BOX (0.113" DIA., 2-1/2" LENGTH)
- 10D COMMON (0.148" DIA., 3" LENGTH)
- 10D BOX (0.128" DIA., 3" LENGTH)
- 16D COMMON (0.162" DIA., 3-1/2" LENGTH)
- 16D SINKER (0.148" DIA., 3-1/4" LENGTH)
- 5D COOLER (0.086" DIA., 1-5/8" LENGTH)
- 6D COOLER (0.092" DIA., 1-7/8" LENGTH)

SHEATHING

TYPICAL ROOF SHEATHING SHALL BE APA RATED 7/16" SHEATHING WITH A SPAN INDEX OF 24/16. FLOOR SHEATHING SHALL BE APA RATED 3/4" T&G SHEATHING WITH A SPAN INDEX OF 48/24 UNLESS NOTED OTHERWISE. STAGGER END LAPS AT ROOF AND FLOOR SHEATHING. WALL SHEATHING SHALL BE APA RATED 7/16" SHEATHING WITH A SPAN INDEX OF 24/0 UNLESS NOTED OTHERWISE.

GLULAM BEAMS (GLB)

GLULAM BEAMS SHALL BE 24F-V4 FOR SINGLE SPANS AND 24F-V8 FOR CONTINUOUS OR CANTILEVER SPANS WITH THE FOLLOWING MINIMUM PROPERTIES: Fb=2400 PSI, Fv=240 PSI, Fc=650 PSI (PERPENDICULAR), E=1,800,000 PSI.

ENGINEERED WOOD BEAMS AND I-JOIST

CONTRACTOR SHALL SUBMIT SHOP DRAWINGS AND SPECIFICATIONS FOR APPROVAL BY BUILDING OFFICIAL. DESIGN, FABRICATION AND ERECTION IN ACCORDANCE WITH THE LATEST ICC EVALUATION REPORT.

BEAMS DESIGNATED AS "PSL" SHALL HAVE THE MINIMUM PROPERTIES: Fb=2900 PSI, Fv=290 PSI, Fc=750 PSI (PERPENDICULAR), E=2,000,000 PSI. BEAMS DESIGNATED AS "LVL" SHALL HAVE THE MINIMUM PROPERTIES: Fb=2600 PSI, Fv=285 PSI, Fc=750 PSI (PERPENDICULAR), E=1,900,000 PSI. BEAMS DESIGNATED AS "LSL" SHALL HAVE THE MINIMUM PROPERTIES: Fb=1700 PSI, Fv=400 PSI, Fc=680 PSI (PERPENDICULAR), E=1,300,000 PSI.

PRE-ENGINEERED ROOF TRUSSES

PRE-ENGINEERED ROOF TRUSSES IS A DEFERRED SUBMITTAL ITEM AND IS TO BE DESIGNED, FABRICATED AND INSTALLED PER THE LATEST TRUSS PLATE INSTITUTE STANDARDS, AND IBC SECTION 2303.4. PREFABRICATED ITEMS TO BE DESIGNED BY A LICENSED PROFESSIONAL ENGINEER. THE FABRICATOR SHALL PROVIDE ALL CONNECTION DESIGN, DETAILS AND INSTALLATION INSTRUCTIONS, WHICH SHALL BE AVAILABLE ON SITE FOR INSPECTION. WHERE TRUSSES ARE NOT PROVIDED TO COMPLETE THE ROOF SYSTEM, OVERFRAMING MEMBERS AND CONNECTIONS SHALL BE PROVIDED. OVERFRAMING DETAILS SHALL BE INCLUDED IN THE TRUSS SHOP DRAWINGS IN ORDER TO PROVIDE LOADING CONDITIONS CONSISTENT WITH THE MODELING OF THE TRUSSES. THE OVERFRAMING AND RELATED DETAILS SHALL BE DESIGNED BY THE TRUSS ENGINEER. TRUSSES (OR DRAG TRUSSES) ALIGNING WITH SHEAR WALLS SHALL BE SPECIAL TRUSSES THAT HAS BEEN DESIGNED TO TRANSFER THE SPECIFIC WIND AND SEISMIC LOADS SHOWN ON THE PLANS. THE TRUSS SHALL BE DESIGNED TO TRANSFER THE LOAD BETWEEN THE ROOF SHEATHING AND THE SHEAR WALL BELOW. THE TRUSS SHALL BE DESIGNED TO TRANSFER A MINIMUM OF 100 PLF ALONG THE LENGTH OF THE TRUSS. TEMPORARY AND PERMANENT BRACING REQUIRED FOR THE STABILITY OF THE TRUSS ELEMENTS UNDER GRAVITY LOADS AND IN-PLANE WIND OR SEISMIC LOADS SHALL BE DESIGNED BY THE TRUSS ENGINEER WHERE THE TRUSS CHORD IS NOT DIRECTLY ATTACHED TO THE ROOF SHEATHING. THE TRUSS ENGINEER SHALL DESIGN AND SHOW THE PLACEMENT OF ALL REQUIRED TOP CHORD BRACING AND CONNECTIONS ON THE TRUSS SHOP DRAWINGS. ANY BRACING LOADS TRANSFERRED TO THE MAIN BUILDING SYSTEM SHALL BE IDENTIFIED AND SUBMITTED TO THE ENGINEER OF RECORD FOR REVIEW. DESIGN CALCULATIONS AND SHOP DRAWINGS SHALL BE SUBMITTED FOR REVIEW BY THE ENGINEER OF RECORD PRIOR TO SUBMITTING TO THE BUILDING OFFICIAL FOR APPROVAL. ROOF TRUSS TOP CORD MUST BE HF#2 OR BETTER.

SPECIAL INSPECTIONS

SOILS (PER IBC 1705.6):
 CONTINUOUS SPECIAL INSPECTION SHALL BE REQUIRED FOR MATERIAL DENSITIES AND LIFT THICKNESS DURING PLACEMENT AND COMPACTION OF COMPACTED STRUCTURAL FILL AND PERIODIC SPECIAL INSPECTION IS REQUIRED TO VERIFY SHALLOW FOUNDATIONS BEARING MATERIAL MEETS DESIGNED BEARING CAPACITY, VERIFYING EXCAVATION ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL, PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIAL AND TO INSPECT SUBGRADE MATERIAL PRIOR TO COMPACTED FILL PLACEMENT TO VERIFY THE SITE HAS BEEN PREPARED PROPERLY.

WOOD CONSTRUCTION (PER IBC 1705.5) AND WIND RESISTANCE (PER IBC 1705.11):
 PERIODIC SPECIAL INSPECTION IS REQUIRED TO VERIFY NAILING, BOLTING, ANCHORING AND OTHER FASTENING OF ELEMENTS OF SHEAR WALLS WITH NAIL SPACING 4" AND LESS, DRAG STRUTS, BRACES AND HOLD DOWNS.

CONCRETE (PER IBC 1705.3):
 PERIODIC SPECIAL INSPECTION IS REQUIRED FOR ADHESIVE & MECHANICAL POST INSTALLED ANCHORS TO VERIFY DRILLED HOLE DEPTH, DIAMETER AND TO VERIFY THE HOLE HAS BEEN CLEANED PRIOR TO ANCHOR INSTALLATION. LOAD TESTING MAY BE REQUIRED BY ENGINEER OF RECORD IF POST INSTALLED ANCHORS ARE REQUIRED FOR MISPLACED/MISSING HOLD DOWN ANCHOR BOLTS.

POST-INSTALLED ANCHORS

- POST-INSTALLED ANCHORS SHALL ONLY BE USED WHERE SPECIFIED ON THE DRAWINGS. CONTRACTOR SHALL OBTAIN APPROVAL FROM ENGINEER OF RECORD (EOR) PRIOR TO USING POST-INSTALLED ANCHORS FOR MISSING OR MISPLACED ANCHORS.
- CARE SHALL BE GIVEN TO AVOID CONFLICTS WITH EXISTING REINFORCING WHEN DRILLING HOLES. HOLES SHALL BE DRILLED AND CLEANED PER THE MANUFACTURER'S INSTRUCTIONS. ANCHORS SHALL BE INSTALLED PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AT NOT LESS THAN MINIMUM EDGE DISTANCES AND/OR SPACING INDICATED IN THE MANUFACTURER'S LITERATURE.
- SPECIAL INSPECTION SHALL BE PROVIDED FOR ALL ADHESIVE AND MECHANICAL ANCHOR INSTALLATIONS AS REQUIRED BY THE EOR. INDEPENDENT ON-SITE PROOF LOAD TESTING SHALL BE PERFORMED AS REQUIRED BY THE EOR. CONTACT EOR FOR NUMBER OF ANCHORS REQUIRED TO BE TESTED AND REQUIRED PROOF LOAD MAGNITUDE.
- UNLESS NOTED OTHERWISE ON DOCUMENTS, ACCEPTABLE PRODUCTS SHALL BE AS LISTED BELOW:
 - MECHANICAL ANCHORS INTO CONCRETE:
 - USE THE FOLLOWING (UNO):
 - SIMPSON TITEN HD (ICC-ES AC193 AND ACI 355.2) FOR CRACKED & UNCRACKED CONCRETE PER (ICC-ES ESR-2713)
 - HILTI KWIK BOLT TZ CARBON AND STAINLESS STEEL ANCHORS (ICC-ES ESR1917)
 - RED HEAD TRUBOLT + WEDGE ANCHORS (ICC-ES ESR2427)
 - SIMPSON STRONG-TIE STRONG-BOLT (STB) (ICC-ES ESR1771)(FL8668)
 - USE THE FOLLOWING ONLY WHERE SPECIFICALLY CALLED OUT ON THE DOCUMENTS:
 - HILTI HDA (ICC-ES ESR1546)
 - HILTI HSL-3 ANCHOR (ICC-ES ESR1545)
 - SIMPSON STRONG-TIE TITEN HD (THD) (ICC-ES ESR2713)(FL2304)
 - MECHANICAL ANCHORS INTO MASONRY LINTELS OR GROUT FILLED CELLS:
 - USE THE FOLLOWING (UNO):
 - SIMPSON TITEN HD (ICC-AC AC106) FOR MASONRY PER (ICC-ES ESR-1056)
 - HILTI KWIK BOLT 3 MASONRY ANCHORS (ICC-ES ESR1385)
 - SIMPSON STRONG-TIE WEDGE-ALL ANCHOR(WA) (ICBO-ES ER-3631) (FL5415)
 - USE THE FOLLOWING ONLY WHERE SPECIFICALLY CALLED OUT ON THE DOCUMENTS:
 - HILTI HUS-H SCREW ANCHOR (ICC-ES ESR2369)
 - SIMPSON STRONG-TIE TITEN HD (THD) (ICC-ES ESR1056)(FL2304)
 - ADHESIVE ANCHORS INTO CONCRETE:
 - USE THE FOLLOWING (UNO):
 - HILTI HIT-RE 500-SD ADHESIVE (ICC-ES ESR2322)
 - RED HEAD EPCON G5 ADHESIVE (ICC-ES ESR1137)(FL6582)
 - SIMPSON STRONG-TIE SET-XP EPOXY-TIE ADHESIVE (SETXP) (ICC-ES ESR2508)
 - USE THE FOLLOWING ONLY WHERE SPECIFICALLY CALLED OUT ON THE DOCUMENTS:
 - HILTI HIT HY 150 MAX ADHESIVE (ICC-ES ESR2262)
 - ADHESIVE ANCHORS INTO MASONRY LINTELS OR GROUT FILLED CELLS:
 - USE THE FOLLOWING (UNO):
 - HILTI HIT HY-150 MAX ADHESIVE (ICC-ES ESR1967)
 - SIMPSON STRONG-TIE SET EPOXY-TIE ADHESIVE (SET) (ICC-ES ESR1772)(FL5550)



PIERUCCIONI E&C, LLC
 CHON PIERUCCIONI, PE
 2024 N. BARNETT ST. TACOMA, WA 98402
 PIERUCCIONEENGINEERING@GMAIL.COM
 206.940.7969

RELEASE OF DOCUMENTS
 THIS DOCUMENT AND THE ENGINEERING OR PROFESSIONAL SERVICES ARE THE PROPERTY OF PIERUCCIONI ENGINEERING AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN APPROVAL OF PIERUCCIONI E&C, LLC

PRGA20250487




EAST TOWN CROSSING
 BUILDING 'A'
 PIONEER & SHAW PUYALLUP WA

REVISIONS

NO.	DATE	DESCRIPTION
01		---

REVISIONS

DRAWN BY:	CP
CHECKED BY:	CP
DATE:	2023.03.05
TITLE:	STRUCTURAL NOTES
PROJECT #:	---
SHEET:	

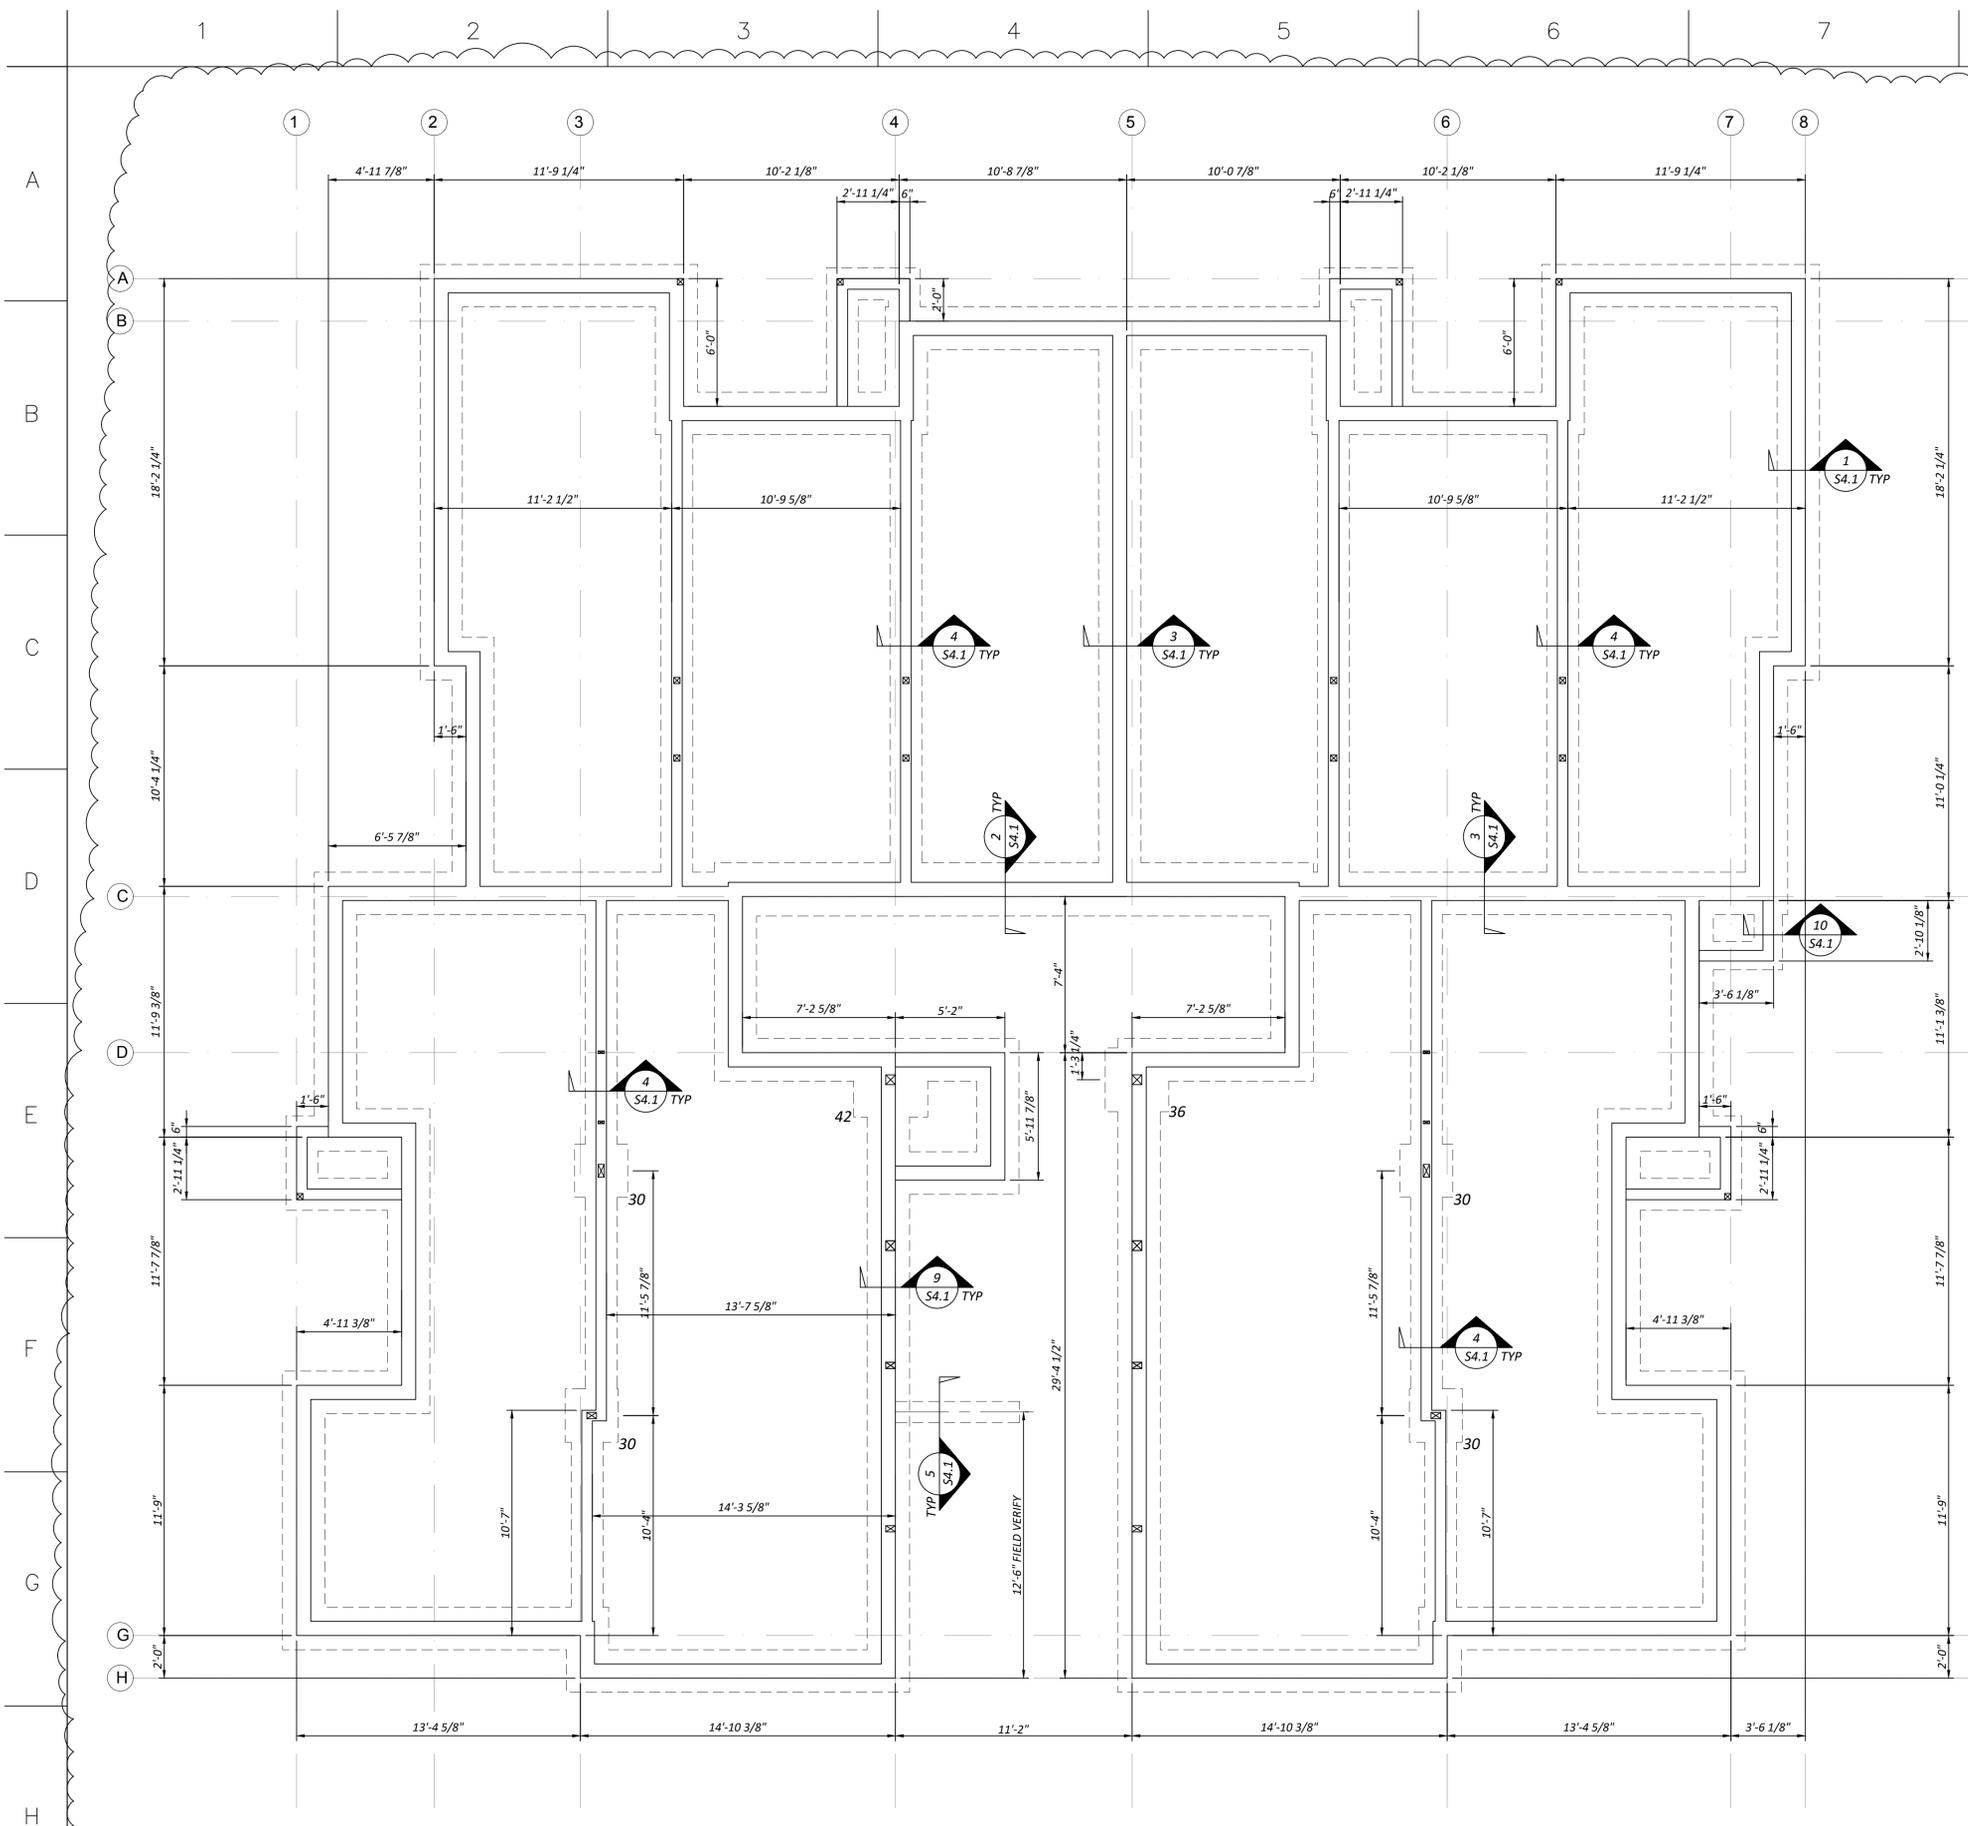

FOUNDATION PLAN
1/4" = 1'-0"

NOTES:

- PER KRAZAN & ASSOCIATES, INC. REPORT DATED APRIL 11, 2019, FOUNDATION DESIGN IS BASED ON AN ASSUMED AVERAGE SOIL BEARING OF 2,000 PSF. EXTERIOR FOOTINGS SHALL BEAR 18" & INTERIOR FOOTINGS SHALL BEAR 12" (MINIMUM) BELOW FINISHED GRADE. ALL FOOTINGS TO BEAR ON FIRM UNDISTURBED EARTH BELOW ORGANIC SURFACE SOILS OR ON STRUCTURAL FILL PER THE GEOTECHS RECOMMENDATIONS. IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY THAT THE SITE SOILS PROVIDE THIS MINIMUM BEARING CAPACITY.
- EXTERIOR FOOTINGS TO BE A MINIMUM OF 18" BELOW FINISHED GRADE BEARING ON NATIVE UNDISTURBED SOIL OR STRUCTURAL FILL.
- INTERNAL FOOTINGS TO BE A MINIMUM OF 12" BELOW FINISHED GRADE BEARING ON NATIVE UNDISTURBED SOIL OR STRUCTURAL FILL.
- INTERIOR S.O.G. SHALL BE 4" THICK SLAB ON GRADE OVER INSULATION (PER ARCH.), OVER VAPOR BARRIER (PER ARCH.) OVER 4" COMPACTED SAND OR GRAVEL. SLAB SHALL BE REINFORCED WITH 6X6 W2.9XW2.9 WELDED WIRE, #3 BARS @ 24" O.C., OR HELIX FABRIC (5# PER CUBIC YARD).
- EXTERIOR SLAB SHALL BE 4" THICK SLAB ON GRADE SLOPED AT 1% AWAY FROM BUILDING..
- CONTROL JOISTS SHALL BE 15' O.C. MAX.
- SEE SHEAR WALL PLAN ON SHEET S3.6 FOR HOLD DOWN AND ANCHOR BOLT LOCATIONS NOT SHOWN HERE.

FOOTING SCHEDULE

30	POST ON 30" SQUARE X 8" THICK CONC. FOOTING
36	POST ON 36" SQUARE X 8" THICK CONC. FOOTING W/ 4-#4 BARS E.W.
42	POST ON 42" SQUARE X 8" THICK CONC. FOOTING W/ 4-#4 BARS E.W.

NOTES:

- USE MIN. 6" WIDE POST BELOW BEAM SPLICES
- USE 4X4 POST BELOW 4X BEAMS, U.N.O.
- USE 6X6 POST BELOW 6X BEAMS, U.N.O.
- PT POST SHALL BE USED IN EXTERIOR CONDITIONS



PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
210 N. BENNETT ST. TACOMA, WA 98402
PIERUCCIONIENGINEERING@GMAIL.COM
206.849.7888

RELEASE OF DOCUMENTS
THIS DOCUMENT IS THE PROPERTY OF
PIERUCCIONI ENGINEERING, LLC. THE PROPERTY OF
PIERUCCIONI ENGINEERING, LLC. IS NOT TO BE
REPRODUCED IN WHOLE OR IN PART WITHOUT THE
WRITTEN AUTHORIZATION OF PIERUCCIONI E&C, LLC.

PRGA20250487

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building	Planning
Engineering	Public Works
Fire	Traffic


**EAST TOWN CROSSING
BUILDING 'A'
PIONEER & SHAW PUYALLUP WA**

REVISIONS

01	REVIEW 1 2024.08.05
----	------------------------

REVISIONS

DRAWN BY:	CP
CHECKED BY:	CP
DATE:	2023.03.05
TITLE:	FOUNDATION PLAN
PROJECT #:	----
SHEET:	

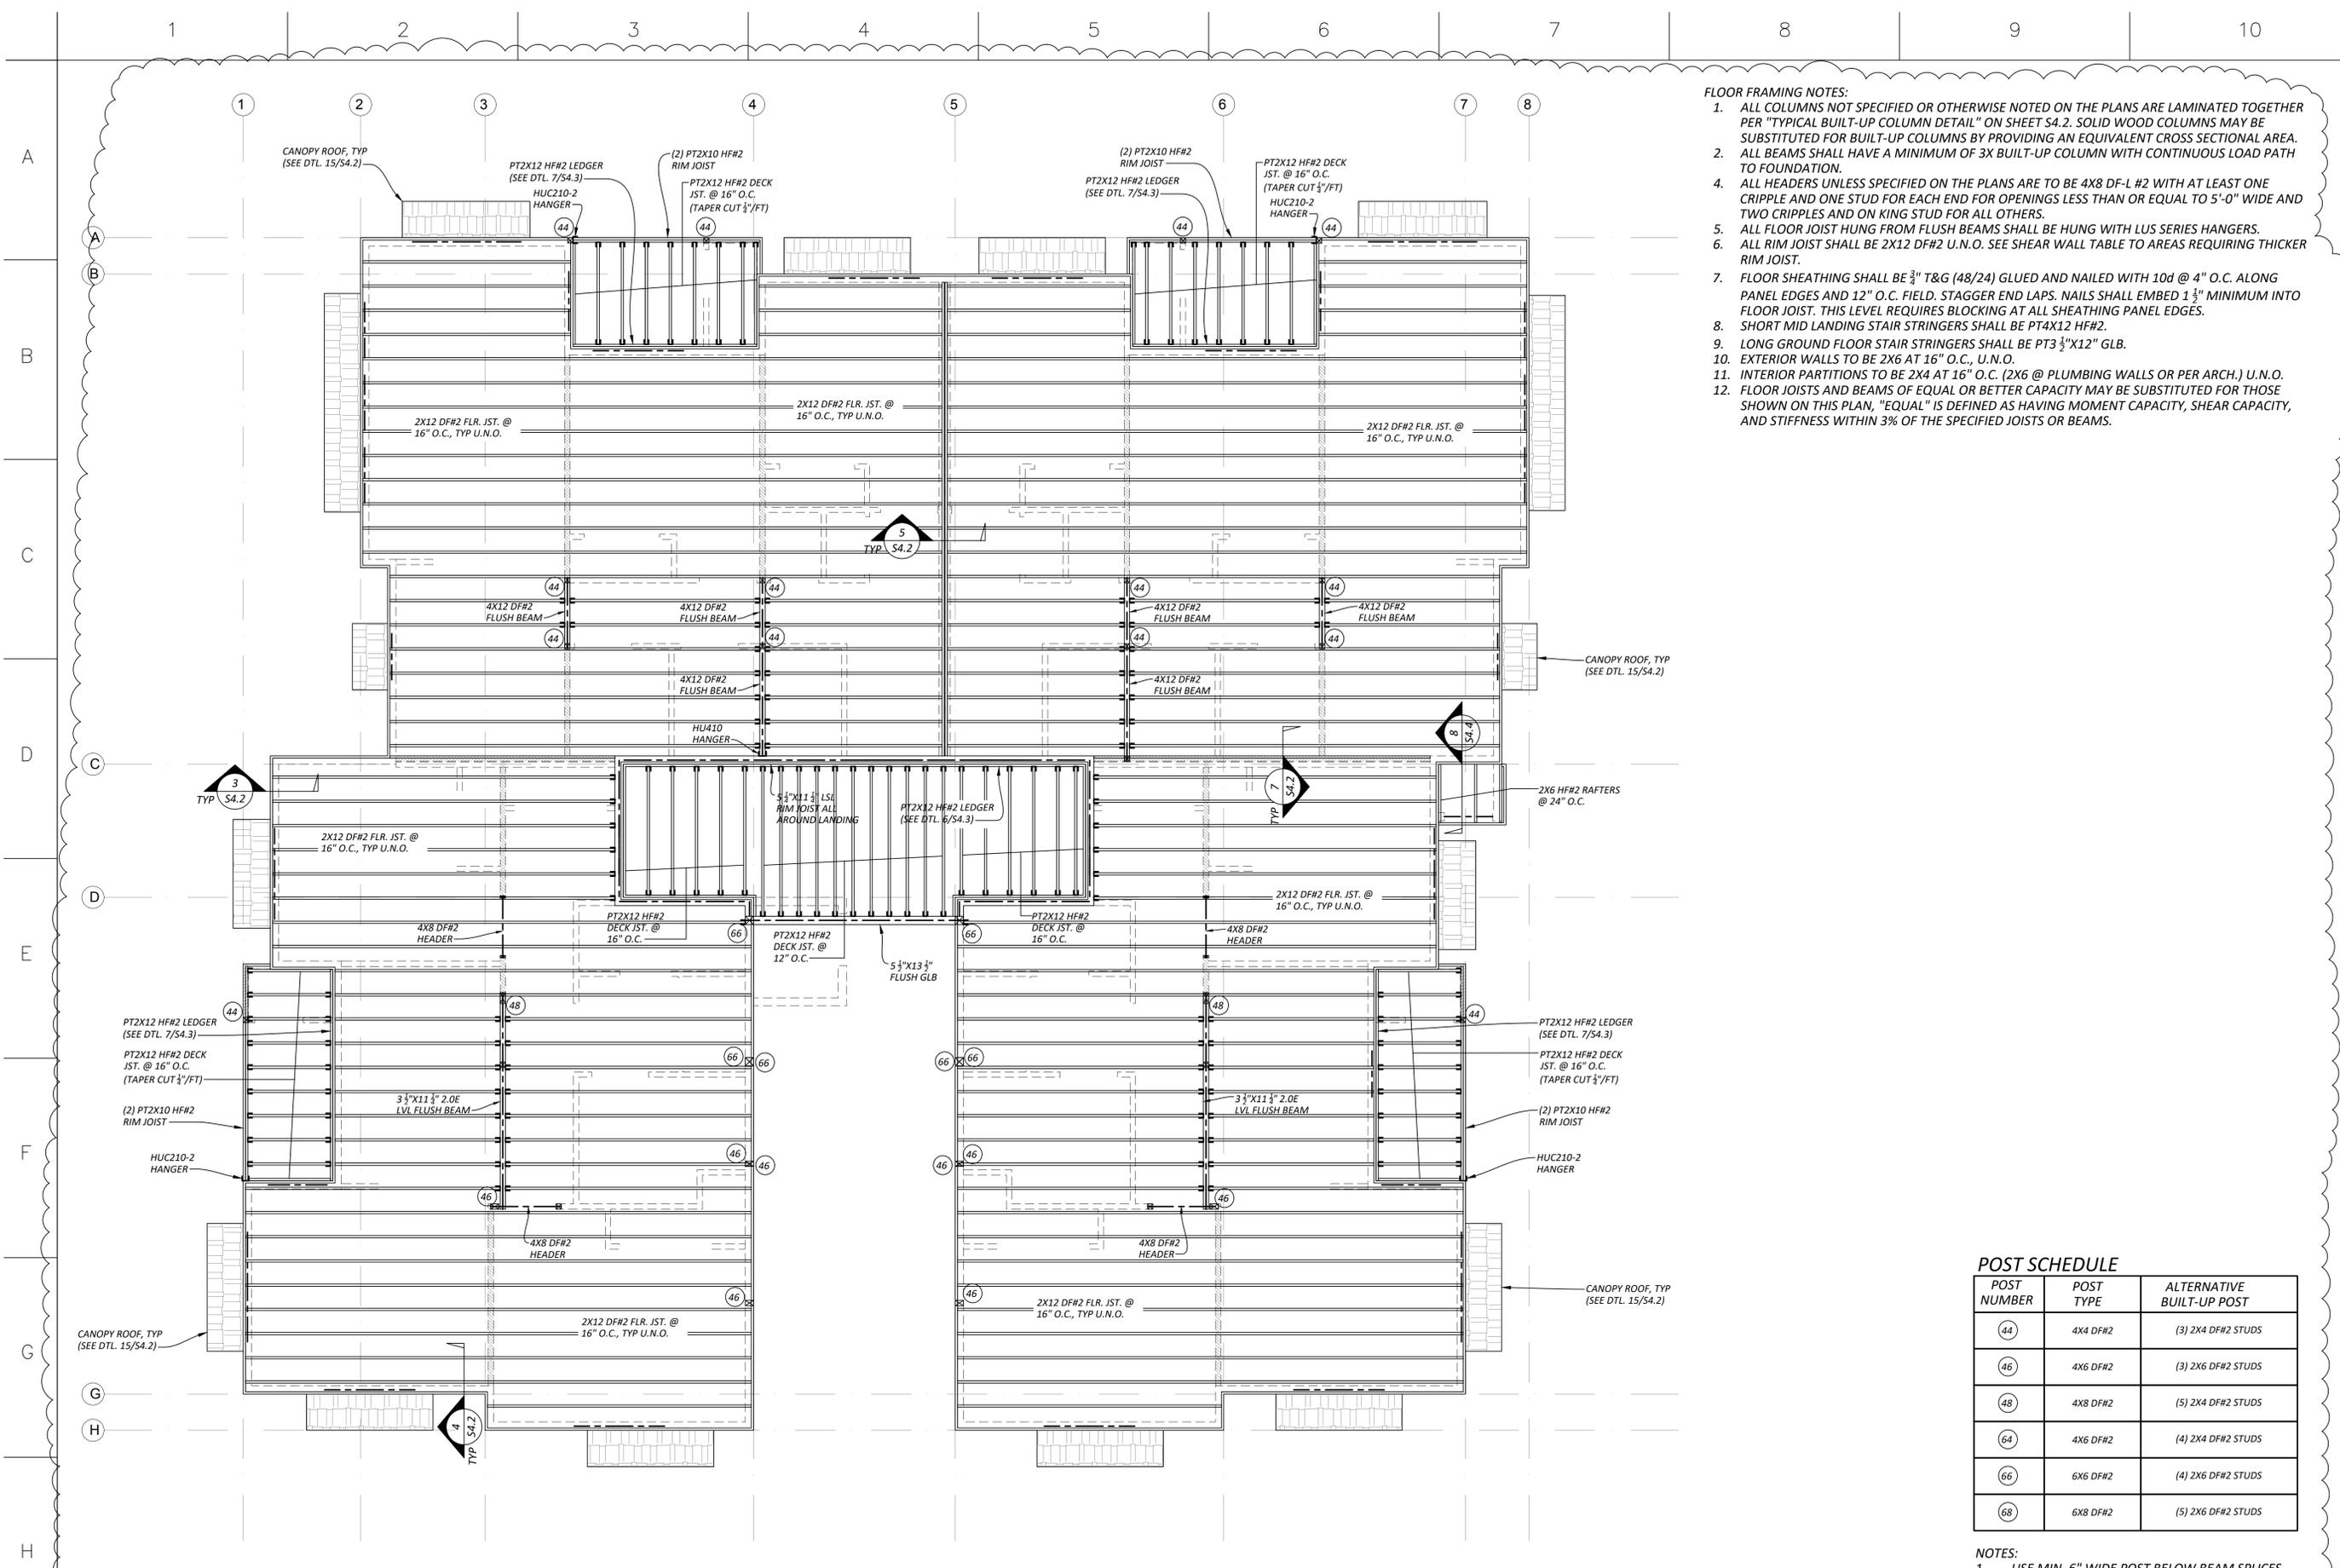

LEVEL 2 FRAMING PLAN
1/4" = 1'-0"

- FLOOR FRAMING NOTES:**
1. ALL COLUMNS NOT SPECIFIED OR OTHERWISE NOTED ON THE PLANS ARE LAMINATED TOGETHER PER "TYPICAL BUILT-UP COLUMN DETAIL" ON SHEET S4.2. SOLID WOOD COLUMNS MAY BE SUBSTITUTED FOR BUILT-UP COLUMNS BY PROVIDING AN EQUIVALENT CROSS SECTIONAL AREA.
 2. ALL BEAMS SHALL HAVE A MINIMUM OF 3X BUILT-UP COLUMN WITH CONTINUOUS LOAD PATH TO FOUNDATION.
 4. ALL HEADERS UNLESS SPECIFIED ON THE PLANS ARE TO BE 4X8 DF-L #2 WITH AT LEAST ONE CRIPPLE AND ONE STUD FOR EACH END FOR OPENINGS LESS THAN OR EQUAL TO 5'-0" WIDE AND TWO CRIPPLES AND ONE KING STUD FOR ALL OTHERS.
 5. ALL FLOOR JOIST HUNG FROM FLUSH BEAMS SHALL BE HUNG WITH LUS SERIES HANGERS.
 6. ALL RIM JOIST SHALL BE 2X12 DF#2 U.N.O. SEE SHEAR WALL TABLE TO AREAS REQUIRING THICKER RIM JOIST.
 7. FLOOR SHEATHING SHALL BE 3/4" T&G (48/24) GLUED AND NAILED WITH 10d @ 4" O.C. ALONG PANEL EDGES AND 12" O.C. FIELD. STAGGER END LAPS. NAILS SHALL EMBED 1 1/2" MINIMUM INTO FLOOR JOIST. THIS LEVEL REQUIRES BLOCKING AT ALL SHEATHING PANEL EDGES.
 8. SHORT MID LANDING STAIR STRINGERS SHALL BE PT4X12 HF#2.
 9. LONG GROUND FLOOR STAIR STRINGERS SHALL BE PT3 1/2"X12" GLB.
 10. EXTERIOR WALLS TO BE 2X6 AT 16" O.C., U.N.O.
 11. INTERIOR PARTITIONS TO BE 2X4 AT 16" O.C. (2X6 @ PLUMBING WALLS OR PER ARCH.) U.N.O.
 12. FLOOR JOISTS AND BEAMS OF EQUAL OR BETTER CAPACITY MAY BE SUBSTITUTED FOR THOSE SHOWN ON THIS PLAN, "EQUAL" IS DEFINED AS HAVING MOMENT CAPACITY, SHEAR CAPACITY, AND STIFFNESS WITHIN 3% OF THE SPECIFIED JOISTS OR BEAMS.

POST SCHEDULE

POST NUMBER	POST TYPE	ALTERNATIVE BUILT-UP POST
44	4X4 DF#2	(3) 2X4 DF#2 STUDS
46	4X6 DF#2	(3) 2X6 DF#2 STUDS
48	4X8 DF#2	(5) 2X4 DF#2 STUDS
64	4X6 DF#2	(4) 2X4 DF#2 STUDS
66	6X6 DF#2	(4) 2X6 DF#2 STUDS
68	6X8 DF#2	(5) 2X6 DF#2 STUDS

- NOTES:**
1. USE MIN. 6" WIDE POST BELOW BEAM SPLICES
 2. USE 4X4 DF#2 POST BELOW 4X BEAMS, U.N.O.
 3. USE 6X6 DF#2 POST BELOW 6X BEAMS, U.N.O.

PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
2101 N. BENNETT ST. TACOMA, WA 98409
PIERUCCIONIENGINEERING@GMAIL.COM
206.469.7888

PRGA20250487

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building Planning
Engineering Public Works
Fire Traffic


EAST TOWN CROSSING
BUILDING 'A'
PIONEER & SHAW PUYALLUP WA

REVISIONS

NO.	DATE	DESCRIPTION
01	2024.08.05	REVIEW 1

REVISIONS

DRAWN BY: CP
CHECKED BY: CP
DATE: 2023.03.05
TITLE: FRAMING PLAN
PROJECT #: ----
SHEET:

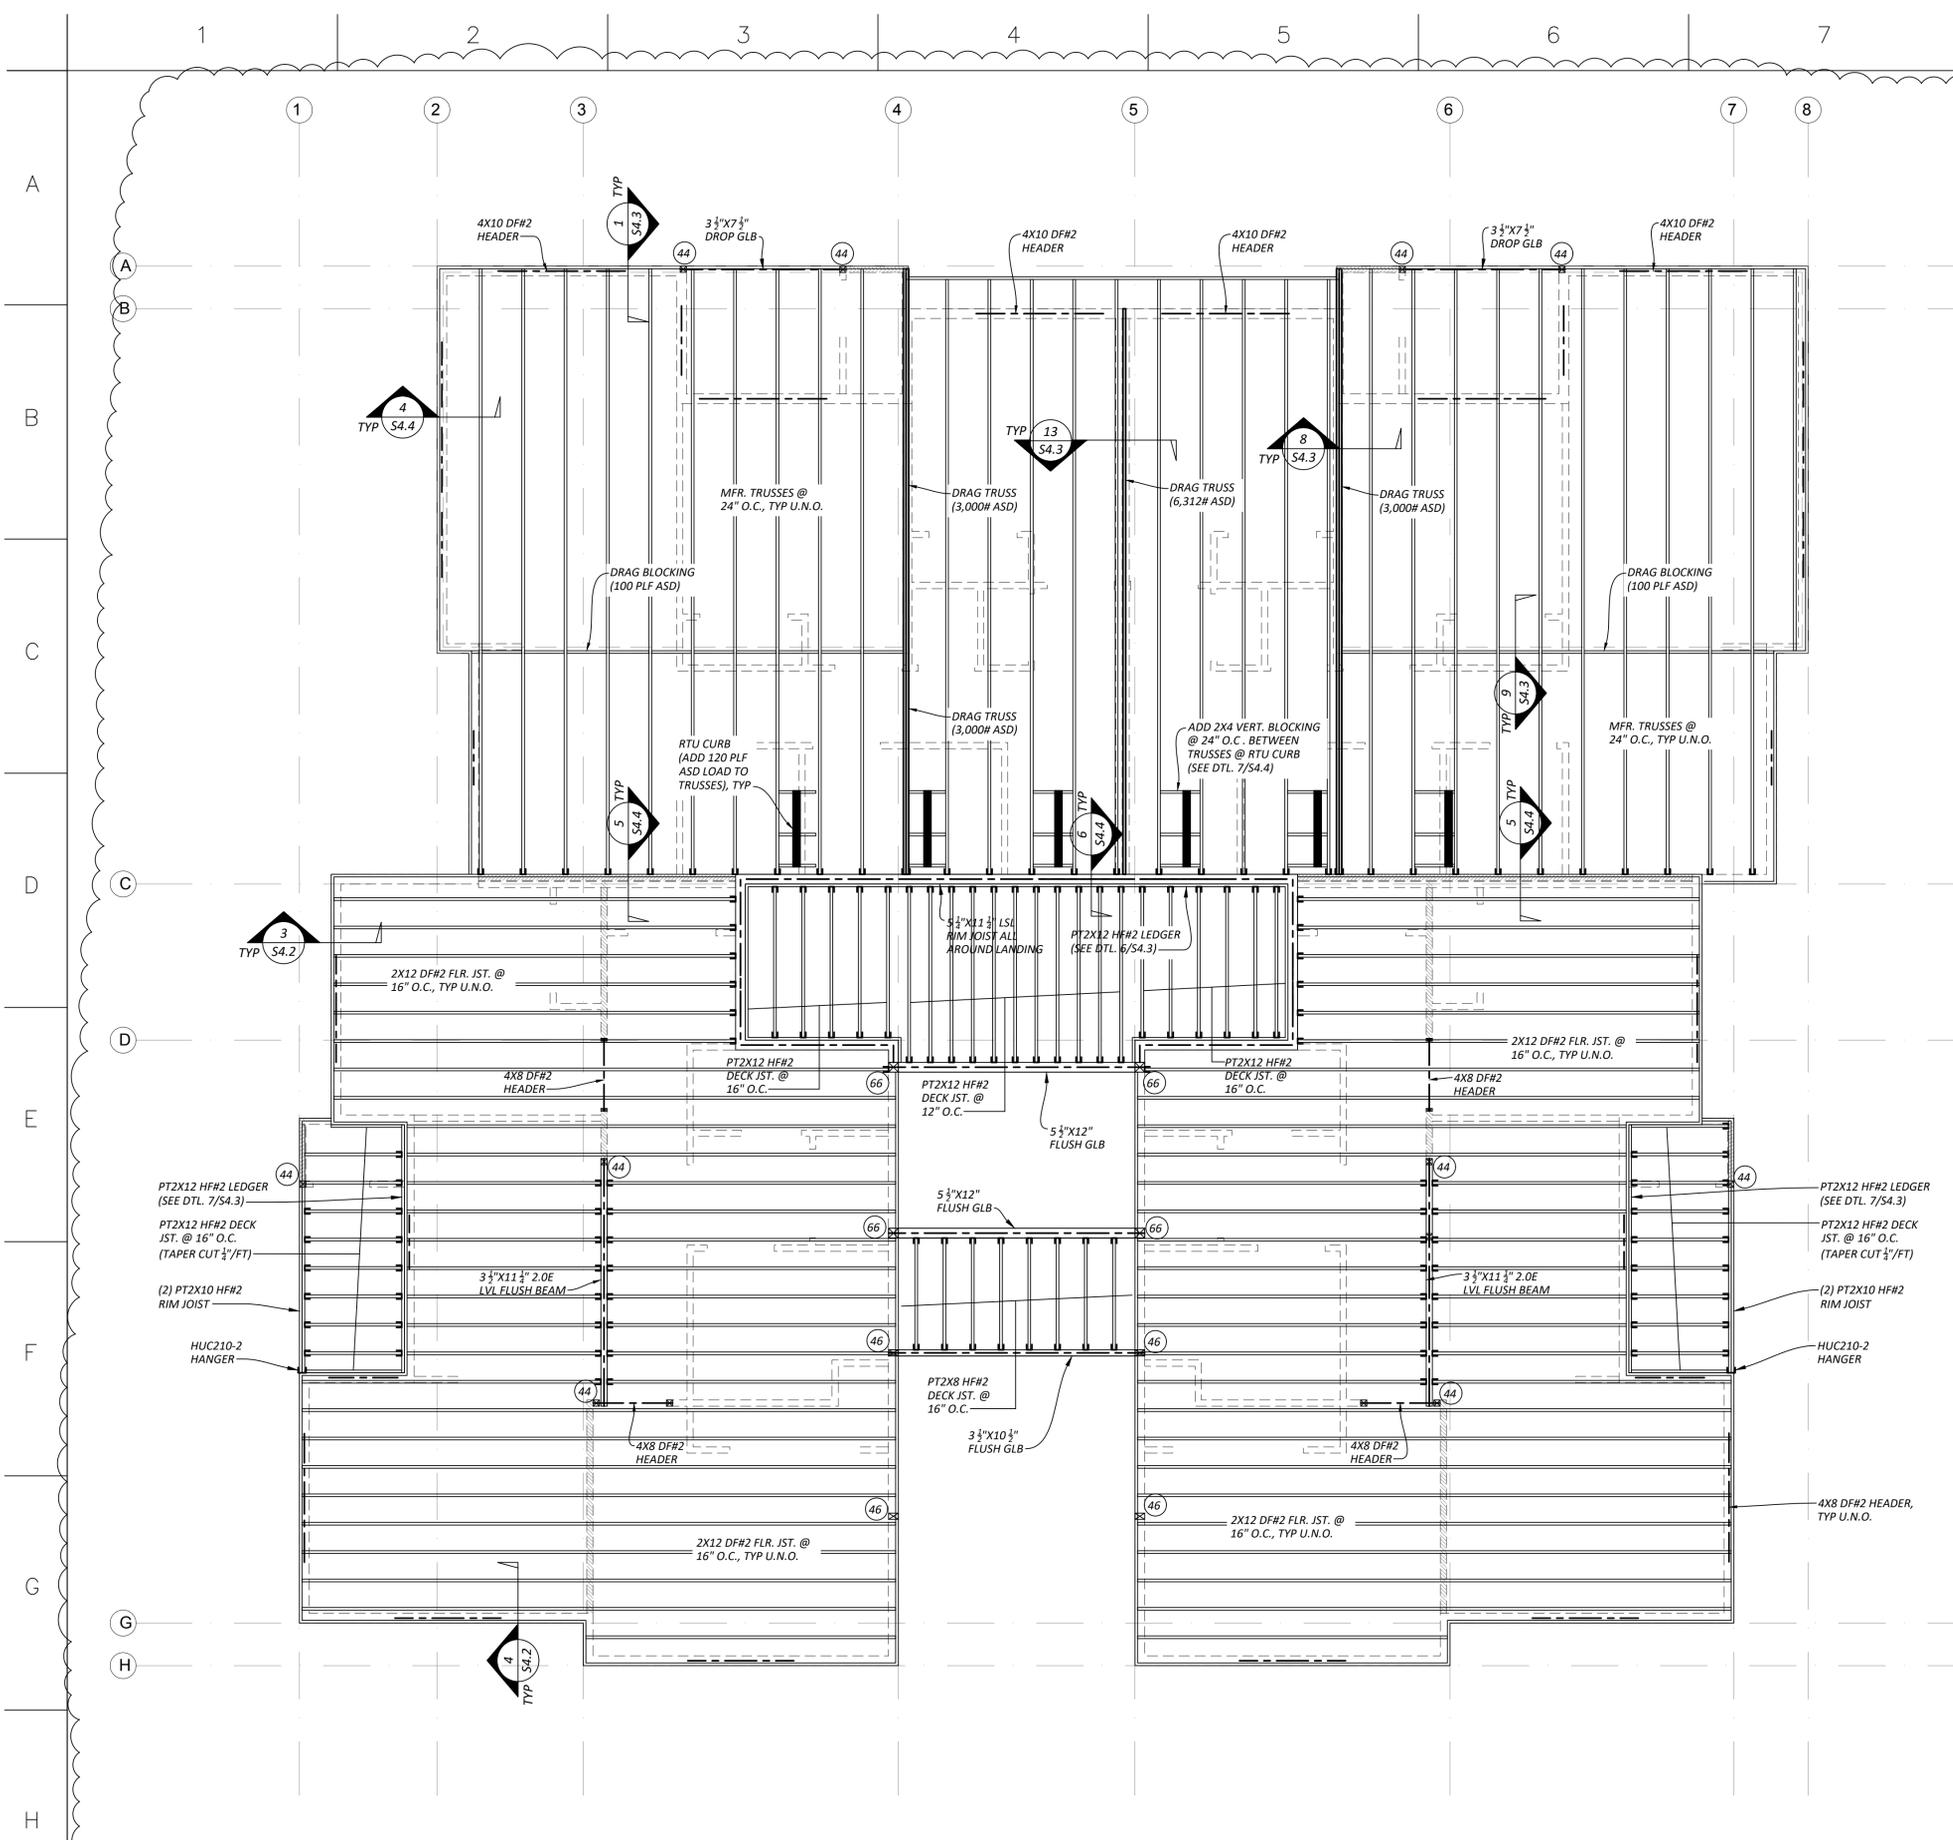

- FLOOR FRAMING NOTES:**
1. ALL COLUMNS NOT SPECIFIED OR OTHERWISE NOTED ON THE PLANS ARE LAMINATED TOGETHER PER "TYPICAL BUILT-UP COLUMN DETAIL" ON SHEET S4.2. SOLID WOOD COLUMNS MAY BE SUBSTITUTED FOR BUILT-UP COLUMNS BY PROVIDING AN EQUIVALENT CROSS SECTIONAL AREA.
 2. ALL BEAMS SHALL HAVE A MINIMUM OF 3X BUILT-UP COLUMN WITH CONTINUOUS LOAD PATH TO FOUNDATION.
 3. ALL HEADERS UNLESS SPECIFIED ON THE PLANS ARE TO BE 4X8 DF-L #2 WITH AT LEAST ONE CRIPPLE AND ONE STUD FOR EACH END FOR OPENINGS LESS THAN OR EQUAL TO 5'-0" WIDE AND TWO CRIPPLES AND ON KING STUD FOR ALL OTHERS.
 4. ALL FLOOR JOIST HUNG FROM FLUSH BEAMS SHALL BE HUNG WITH LUS SERIES HANGERS.
 5. ALL RIM JOIST SHALL BE 2X12 DF#2 U.N.O. SEE SHEAR WALL TABLE TO AREAS REQUIRING THICKER RIM JOIST.
 6. FLOOR SHEATHING SHALL BE 3/8" T&G (48/24) GLUED AND NAILED WITH 10d @ 6" O.C. ALONG PANEL EDGES AND 12" O.C. FIELD. STAGGER END LAPS. NAILS SHALL EMBED 1 1/2" MINIMUM INTO FLOOR JOIST.
 7. SHORT MID LANDING STAIR STRINGERS SHALL BE PT4X12 HF#2.
 8. EXTERIOR WALLS TO BE 2X6 AT 16" O.C., U.N.O.
 9. INTERIOR PARTITIONS TO BE 2X4 AT 16" O.C. (2X6 @ PLUMBING WALLS OR PER ARCH.) U.N.O.
 10. FLOOR JOISTS AND BEAMS OF EQUAL OR BETTER CAPACITY MAY BE SUBSTITUTED FOR THOSE SHOWN ON THIS PLAN, "EQUAL" IS DEFINED AS HAVING MOMENT CAPACITY, SHEAR CAPACITY, AND STIFFNESS WITHIN 3% OF THE SPECIFIED JOISTS OR BEAMS.

- ROOF FRAMING NOTES:**
1. ALL COLUMNS NOT SPECIFIED OR OTHERWISE NOTED ON THE PLANS ARE LAMINATED TOGETHER PER "TYPICAL BUILT-COLUMN DETAIL" ON SHEET S4.2. SOLID WOOD COLUMNS MAY BE SUBSTITUTED FOR BUILT-UP COLUMNS BY PROVIDING AN EQUIVALENT CROSS SECTIONAL AREA.
 2. ALL HEADERS UNLESS SPECIFIED ON THE PLANS ARE TO BE 4X8 DF-L #2 WITH AT LEAST ONE CRIPPLE AND ONE STUD FOR EACH END FOR OPENINGS LESS THAN OR EQUAL TO 5'-0" WIDE AND TWO CRIPPLES AND ON KING STUD FOR ALL OTHERS.
 3. ROOF SHEATHING SHALL BE 1/2" APA RATED SHEATHING NAILED WITH 8d @ 6" O.C. ALONG PANEL EDGES, AND 12" O.C. FIELD. SPAN INDEX SHALL BE 32/16. STAGGER END LAPS. NAILS SHALL MINIMUM 1 1/2" EMBED INTO ROOF STRUCTURE BELOW.
 4. BEARING WALLS ARE INDICATED AS SHADED WALLS
 5. PROVIDE VENTED BLOCKING AT REQUIRED TRUSS/RAFTER BAYS
 6. SHADED AREAS INDICATE OVERFRAMING. ROOF OVER FRAMING (IRC SECTION R802.3): RAFTERS SHALL BE FRAMED TO 2X RIDGE BOARD PER PLAN. RIDGE BOARD SHALL NOT BE LESS IN DEPTH THAN THE CUT END OF THE RAFTER. AT ALL VALLEYS AND HIPS THERE SHALL BE A 2X VALLEY OR HIP RAFTER AND NOT LESS IN DEPTH THAN THE CUT END OR THE RAFTER. (FULL COVERAGE AT RIDGE, HIPS AND VALLEYS).
 7. ALL MANUFACTURED TRUSSES:
 - * SHALL NOT BE FIELD ALTERED WITHOUT ENGINEER'S APPROVAL
 - * SHALL HAVE DESIGN DETAILS AND DRAWINGS ON SITE FOR FRAMING INSPECTION
 - * SHALL BE INSTALLED AND BRACED TO MANUFACTURER'S SPECIFICATION
 - * SHALL CARRY MANUFACTURER'S STAMP ON EACH TRUSS
 8. IF AN ENGINEERED ROOF FRAMING LAYOUT IS PROVIDED BY THE TRUSS SUPPLIER, THAT TRUSS LAYOUT SHALL SUPERCEDE THE TRUSS LAYOUT INDICATED IN THE PLANS. PROVIDE TRUSS LAYOUT AND SPECS ON SITE FOR INSPECTION.
 9. PROVIDE SOLID FRAMING EQUAL TO THE WIDTH OF THE MEMBER BEING SUPPORTED (U.N.O.)

POST SCHEDULE

POST NUMBER	POST TYPE	ALTERNATIVE BUILT-UP POST
44	4X4 DF#2	(3) 2X4 DF#2 STUDS
46	4X6 DF#2	(3) 2X6 DF#2 STUDS
48	4X8 DF#2	(5) 2X4 DF#2 STUDS
64	4X6 DF#2	(4) 2X4 DF#2 STUDS
66	6X6 DF#2	(4) 2X6 DF#2 STUDS
68	6X8 DF#2	(5) 2X6 DF#2 STUDS

- NOTES:**
1. USE MIN. 6" WIDE POST BELOW BEAM SPLICES
 2. USE 4X4 DF#2 POST BELOW 4X BEAMS, U.N.O.
 3. USE 6X6 DF#2 POST BELOW 6X BEAMS, U.N.O.

LEVEL 3 AND LOWER ROOF FRAMING PLAN
1/4" = 1'-0"



PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
2101 N. BENNETT ST. TACOMA, WA 98407
PIERUCCIONIENGINEERING@GMAIL.COM
206.849.7888

PRGA20250487

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building Planning
Engineering Public Works
Fire Traffic


EAST TOWN CROSSING
BUILDING 'A'
PIONEER & SHAW PUYALLUP WA

REVISIONS

NO.	REVISION	DATE
01	REVIEW 1	2024.08.05

DRAWN BY: CP
CHECKED BY: CP
DATE: 2023.03.05
TITLE: FRAMING PLAN
PROJECT #: ----
SHEET:

S3.3

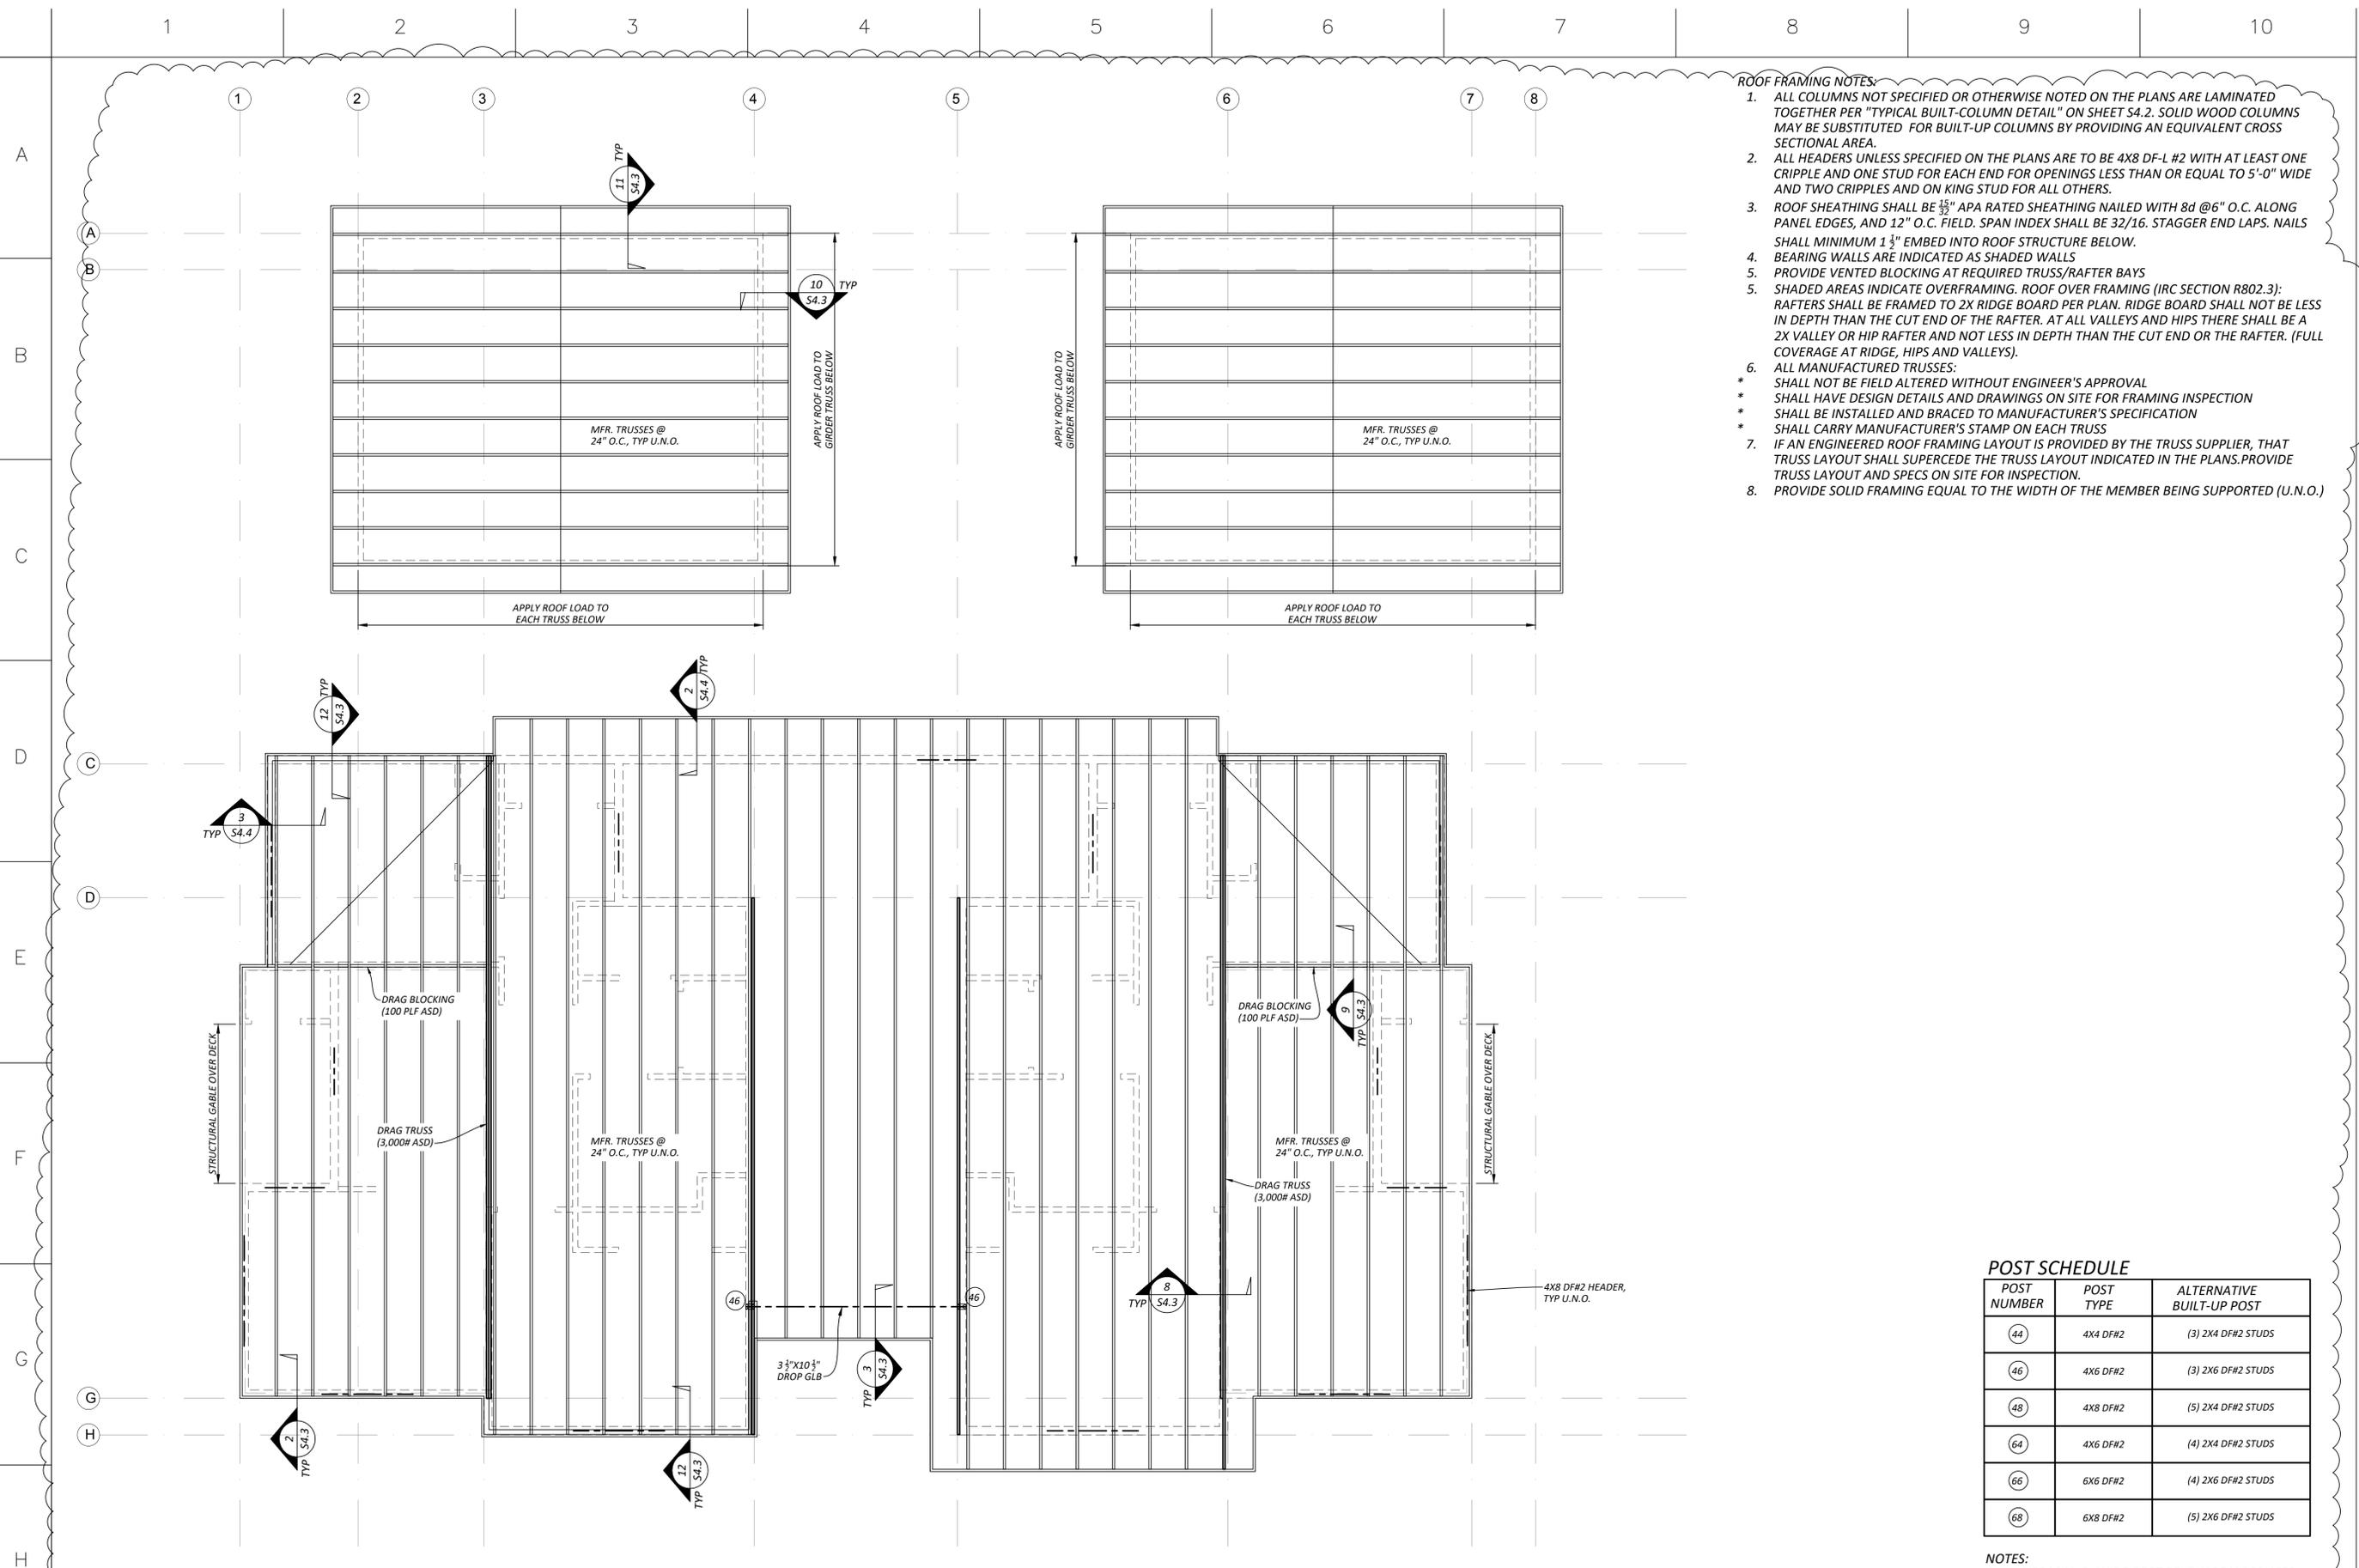

- ROOF FRAMING NOTES:**
- ALL COLUMNS NOT SPECIFIED OR OTHERWISE NOTED ON THE PLANS ARE LAMINATED TOGETHER PER "TYPICAL BUILT-COLUMN DETAIL" ON SHEET S4.2. SOLID WOOD COLUMNS MAY BE SUBSTITUTED FOR BUILT-UP COLUMNS BY PROVIDING AN EQUIVALENT CROSS SECTIONAL AREA.
 - ALL HEADERS UNLESS SPECIFIED ON THE PLANS ARE TO BE 4X8 DF-L #2 WITH AT LEAST ONE CRIPPLE AND ONE STUD FOR EACH END FOR OPENINGS LESS THAN OR EQUAL TO 5'-0" WIDE AND TWO CRIPPLES AND ON KING STUD FOR ALL OTHERS.
 - ROOF SHEATHING SHALL BE 1/2" APA RATED SHEATHING NAILED WITH 8d @ 6" O.C. ALONG PANEL EDGES, AND 12" O.C. FIELD. SPAN INDEX SHALL BE 32/16. STAGGER END LAPS. NAILS SHALL MINIMUM 1 1/2" EMBED INTO ROOF STRUCTURE BELOW.
 - BEARING WALLS ARE INDICATED AS SHADED WALLS
 - PROVIDE VENTED BLOCKING AT REQUIRED TRUSS/RAFTER BAYS
 - SHADED AREAS INDICATE OVERFRAMING. ROOF OVER FRAMING (IRC SECTION R802.3): RAFTERS SHALL BE FRAMED TO 2X RIDGE BOARD PER PLAN. RIDGE BOARD SHALL NOT BE LESS IN DEPTH THAN THE CUT END OF THE RAFTER. AT ALL VALLEYS AND HIPS THERE SHALL BE A 2X VALLEY OR HIP RAFTER AND NOT LESS IN DEPTH THAN THE CUT END OR THE RAFTER. (FULL COVERAGE AT RIDGE, HIPS AND VALLEYS).
 - ALL MANUFACTURED TRUSSES:
 - * SHALL NOT BE FIELD ALTERED WITHOUT ENGINEER'S APPROVAL
 - * SHALL HAVE DESIGN DETAILS AND DRAWINGS ON SITE FOR FRAMING INSPECTION
 - * SHALL BE INSTALLED AND BRACED TO MANUFACTURER'S SPECIFICATION
 - * SHALL CARRY MANUFACTURER'S STAMP ON EACH TRUSS
 - IF AN ENGINEERED ROOF FRAMING LAYOUT IS PROVIDED BY THE TRUSS SUPPLIER, THAT TRUSS LAYOUT SHALL SUPERCEDE THE TRUSS LAYOUT INDICATED IN THE PLANS. PROVIDE TRUSS LAYOUT AND SPECS ON SITE FOR INSPECTION.
 - PROVIDE SOLID FRAMING EQUAL TO THE WIDTH OF THE MEMBER BEING SUPPORTED (U.N.O.)

POST SCHEDULE

POST NUMBER	POST TYPE	ALTERNATIVE BUILT-UP POST
44	4X4 DF#2	(3) 2X4 DF#2 STUDS
46	4X6 DF#2	(3) 2X6 DF#2 STUDS
48	4X8 DF#2	(5) 2X4 DF#2 STUDS
64	4X6 DF#2	(4) 2X4 DF#2 STUDS
66	6X6 DF#2	(4) 2X6 DF#2 STUDS
68	6X8 DF#2	(5) 2X6 DF#2 STUDS

- NOTES:**
- USE MIN. 6" WIDE POST BELOW BEAM SPLICES
 - USE 4X4 DF#2 POST BELOW 4X BEAMS, U.N.O.
 - USE 6X6 DF#2 POST BELOW 6X BEAMS, U.N.O.

MAIN ROOF FRAMING PLAN
1/4" = 1'-0"

PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
3228 N. BENNETT ST. TACOMA, WA 98157
PIERUCCIONIENGINEERING@GMAIL.COM
206.940.7966

PRGA20250487

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building Planning
Engineering Public Works
Fire Traffic

RELEASE OF DOCUMENTS
THIS DOCUMENT AND ITS CONTENTS, INCLUDING ANY INFORMATION OF PROFESSIONAL OPINION, IS THE PROPERTY OF PIERUCCIONI ENGINEERING, LLC. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN. ANY REPRODUCTION OR TRANSMISSION OF THIS DOCUMENT WITHOUT THE WRITTEN AUTHORIZATION OF PIERUCCIONI ENGINEERING, LLC IS PROHIBITED.

EAST TOWN CROSSING
BUILDING 'A'
PIONEER & SHAW PUYALLUP WA

REVISIONS	
01	REVIEW 1 2024.08.05

REVISIONS

DRAWN BY: CP
CHECKED BY: CP
DATE: 2023.03.05
TITLE: FRAMING PLAN
PROJECT #: ---
SHEET:

S3.4



PIERUCCIONI E&C, LLC
 CHON PIERUCCIONI, PE
 2101 N. BENNETT ST. TACOMA, WA 98401
 PIERUCCIONIENGINEERING@GMAIL.COM
 206.849.7888

REUSE OF DOCUMENTS
 THIS DOCUMENT AND THE INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF PIERUCCIONI ENGINEERING AND ARE TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED ON THE DRAWING. REUSE OF THIS DOCUMENT FOR ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF PIERUCCIONI ENGINEERING IS PROHIBITED.

PRGA20250487

City of Puyallup
 Development & Permitting Services
ISSUED PERMIT

Building Planning
 Engineering Public Works
 Fire Traffic

EAST TOWN CROSSING
 BUILDING 'A'
 PIONEER & SHAW PUYALLUP WA


REVISIONS
 REVIEW 1
 2024.08.05

REVISIONS

DRAWN BY: CP
 CHECKED BY: CP
 DATE: 2023.03.05
 TITLE: SHEAR WALL PLAN
 PROJECT #: ----
 SHEET:

S3.6

SPECIAL INSPECTIONS ARE REQUIRED FOR SHEAR WALLS: W2 W3 W4 W5

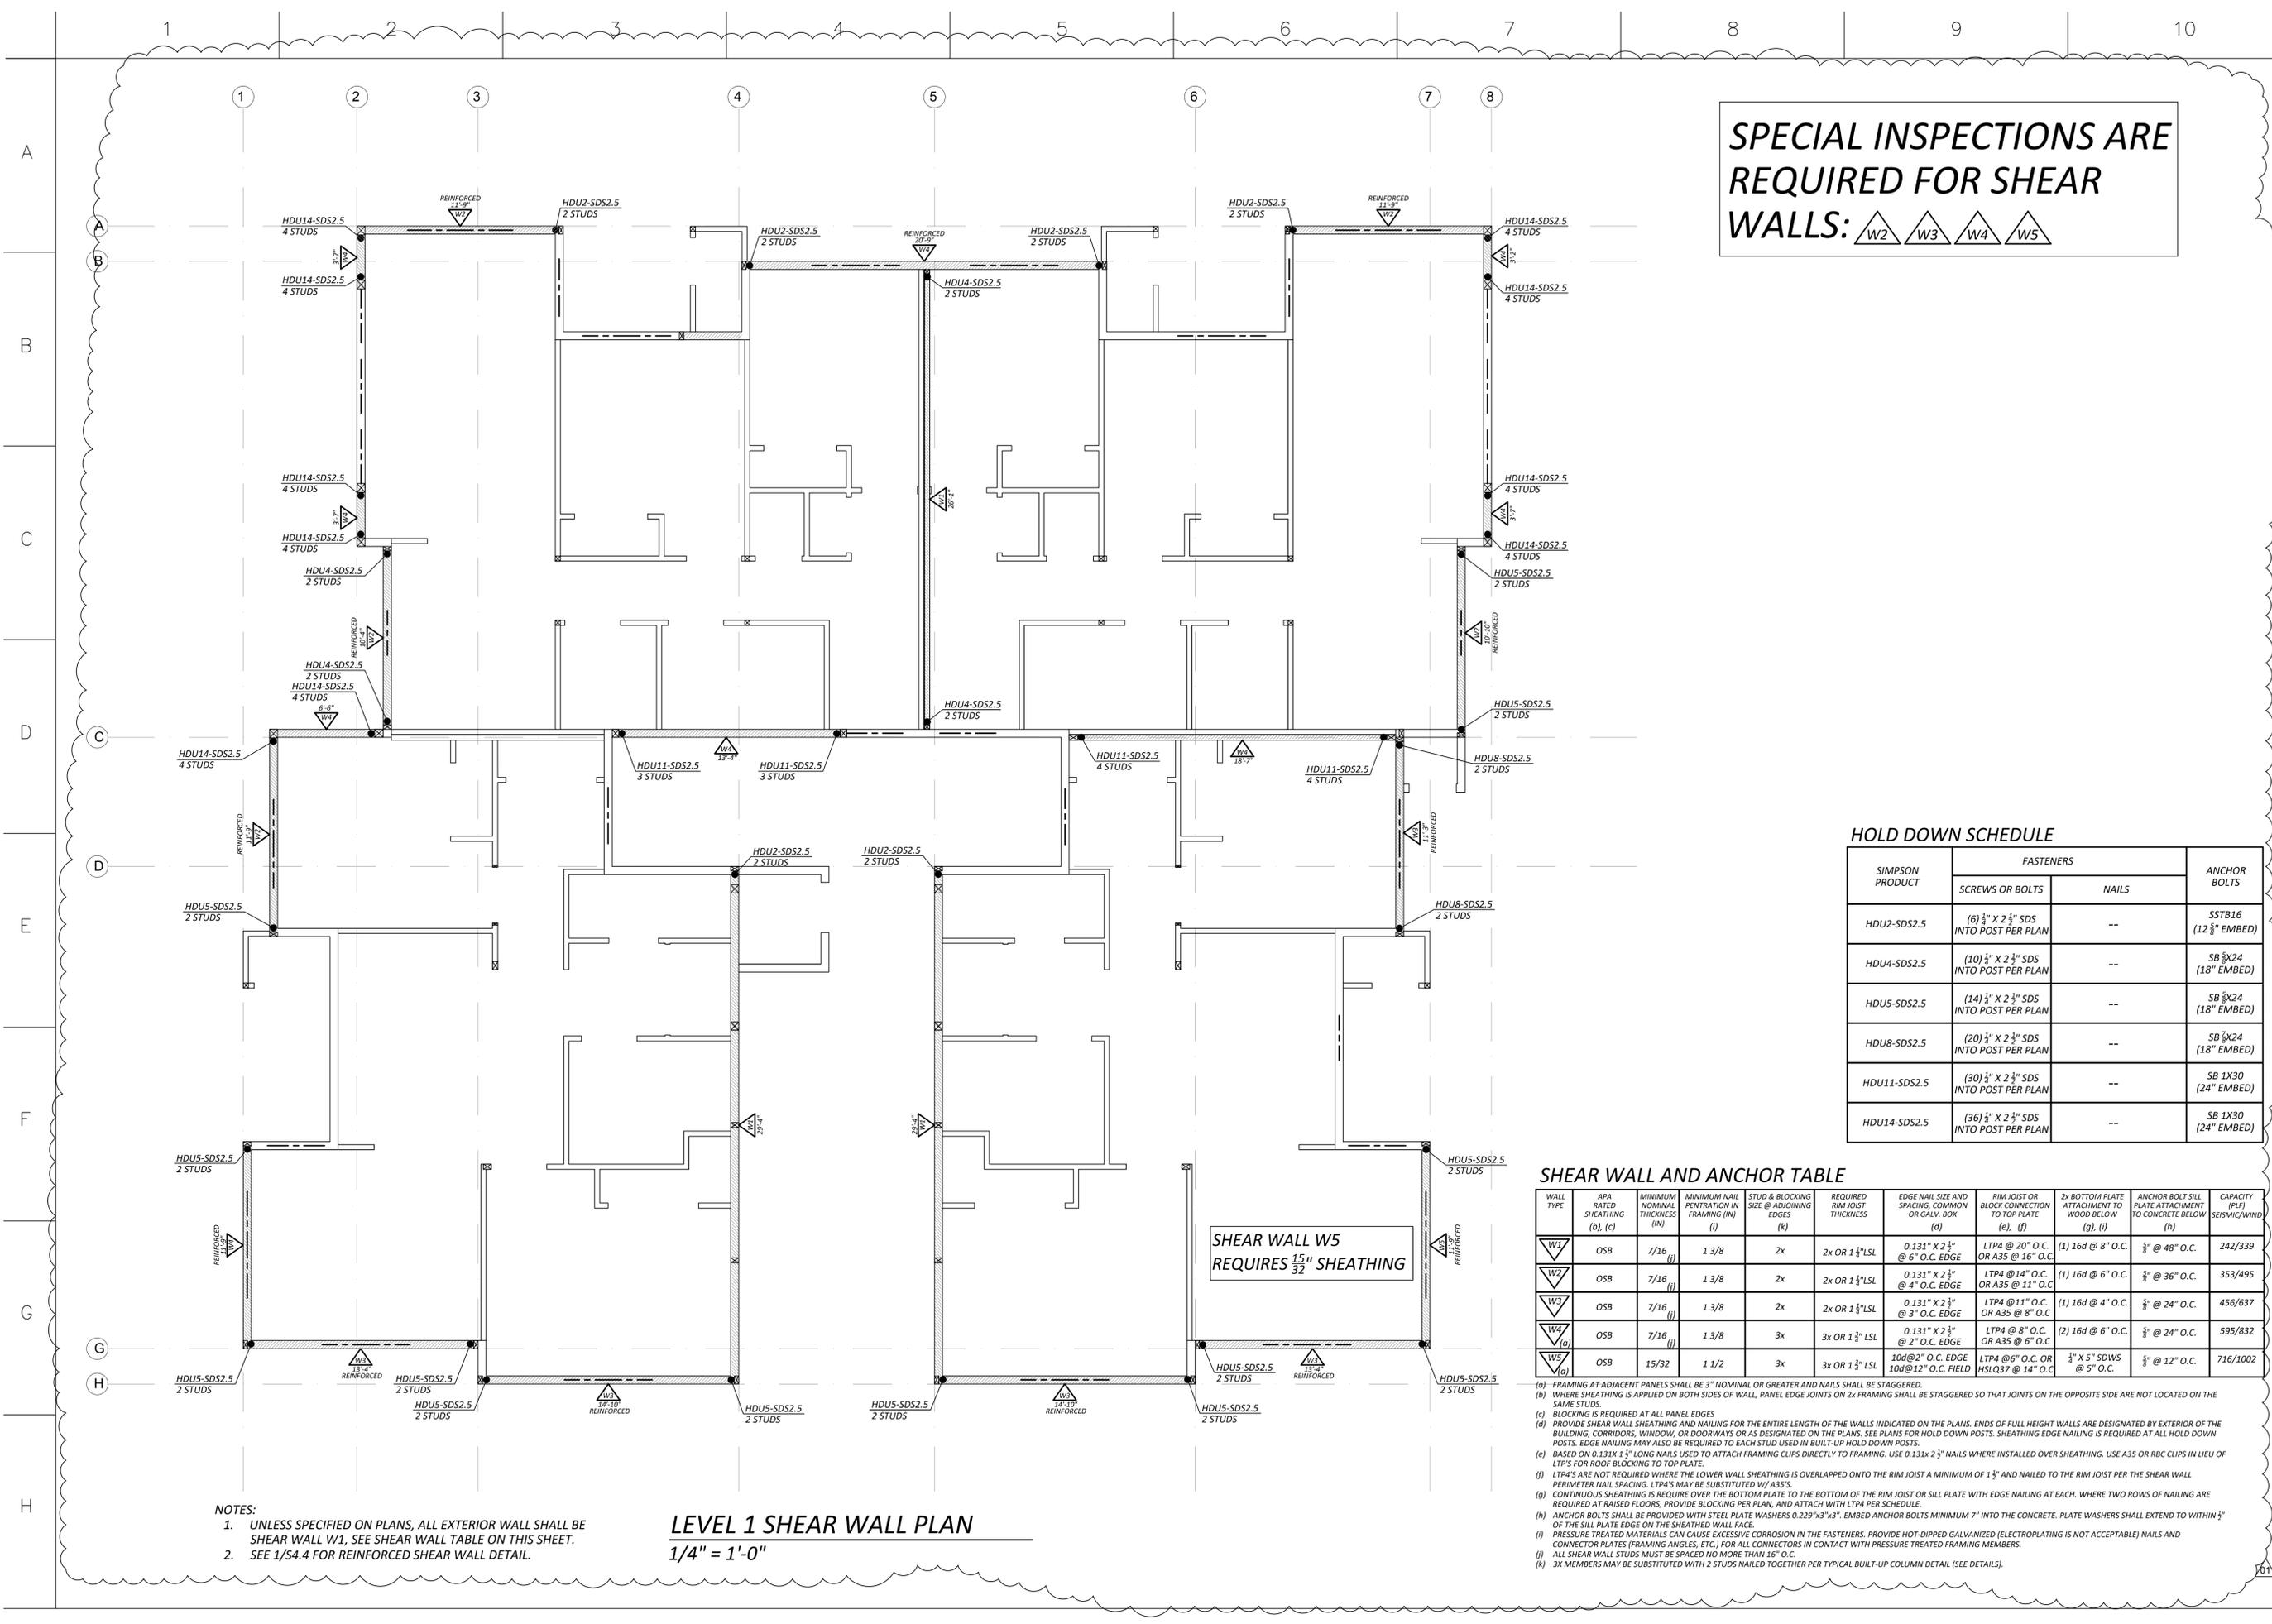

HOLD DOWN SCHEDULE

SIMPSON PRODUCT	FASTENERS		
	SCREWS OR BOLTS	NAILS	ANCHOR BOLTS
HDU2-SDS2.5	(6) 1/4" X 2 1/2" SDS INTO POST PER PLAN	--	SSTB16 (12 3/8" EMBED)
HDU4-SDS2.5	(10) 1/4" X 2 1/2" SDS INTO POST PER PLAN	--	SB 5/8X24 (18" EMBED)
HDU5-SDS2.5	(14) 1/4" X 2 1/2" SDS INTO POST PER PLAN	--	SB 5/8X24 (18" EMBED)
HDU8-SDS2.5	(20) 1/4" X 2 1/2" SDS INTO POST PER PLAN	--	SB 5/8X24 (18" EMBED)
HDU11-SDS2.5	(30) 1/4" X 2 1/2" SDS INTO POST PER PLAN	--	SB 1X30 (24" EMBED)
HDU14-SDS2.5	(36) 1/4" X 2 1/2" SDS INTO POST PER PLAN	--	SB 1X30 (24" EMBED)


SHEAR WALL AND ANCHOR TABLE

WALL TYPE	APA RATED SHEATHING (b), (c)	MINIMUM NOMINAL THICKNESS (IN)	MINIMUM NAIL FRAMING (IN) (f)	STUD & BLOCKING SIZE @ ADJOINING EDGES (k)	REQUIRED RIM JOIST THICKNESS	EDGE NAIL SIZE AND SPACING, COMMON OR GALV. BOX (d)	RIM JOIST OR BLOCK CONNECTION TO TOP PLATE (e), (f)	2x BOTTOM PLATE ATTACHMENT TO WOOD BELOW (g), (i)	ANCHOR BOLT SILL PLATE ATTACHMENT TO CONCRETE BELOW (h)	CAPACITY (PLF) SEISMIC/WIND
W1	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/2" LSL	0.131" X 2 1/2" @ 6" O.C. EDGE	LTP4 @ 20" O.C. OR A35 @ 16" O.C.	(1) 16d @ 8" O.C.	5/8" @ 48" O.C.	242/339
W2	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/2" LSL	0.131" X 2 1/2" @ 4" O.C. EDGE	LTP4 @ 14" O.C. OR A35 @ 11" O.C.	(1) 16d @ 6" O.C.	5/8" @ 36" O.C.	353/495
W3	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/2" LSL	0.131" X 2 1/2" @ 3" O.C. EDGE	LTP4 @ 11" O.C. OR A35 @ 8" O.C.	(1) 16d @ 4" O.C.	5/8" @ 24" O.C.	456/637
W4	OSB	7/16 (j)	1 3/8	3x	3x OR 1 3/4" LSL	0.131" X 2 1/2" @ 2" O.C. EDGE	LTP4 @ 8" O.C. OR A35 @ 6" O.C.	(2) 16d @ 6" O.C.	5/8" @ 24" O.C.	595/832
W5	OSB	15/32	1 1/2	3x	3x OR 1 3/4" LSL	10d @ 2" O.C. EDGE 10d @ 12" O.C. FIELD	LTP4 @ 6" O.C. OR HSLQ37 @ 14" O.C.	1/2" X 5" SDWS @ 5" O.C.	5/8" @ 12" O.C.	716/1002

- (a) FRAMING AT ADJACENT PANELS SHALL BE 3" NOMINAL OR GREATER AND NAILS SHALL BE STAGGERED.
- (b) WHERE SHEATHING IS APPLIED ON BOTH SIDES OF WALL, PANEL EDGE JOINTS ON 2x FRAMING SHALL BE STAGGERED SO THAT JOINTS ON THE OPPOSITE SIDE ARE NOT LOCATED ON THE SAME STUDS.
- (c) BLOCKING IS REQUIRED AT ALL PANEL EDGES.
- (d) PROVIDE SHEAR WALL SHEATHING AND NAILING FOR THE ENTIRE LENGTH OF THE WALLS INDICATED ON THE PLANS. ENDS OF FULL HEIGHT WALLS ARE DESIGNATED BY EXTERIOR OF THE BUILDING, CORRIDORS, WINDOW, OR DOORWAYS OR AS DESIGNATED ON THE PLANS. SEE PLANS FOR HOLD DOWN POSTS. SHEATHING EDGE NAILING IS REQUIRED AT ALL HOLD DOWN POSTS. EDGE NAILING MAY ALSO BE REQUIRED TO EACH STUD USED IN BUILT-UP HOLD DOWN POSTS.
- (e) BASED ON 0.131X 1 1/2" LONG NAILS USED TO ATTACH FRAMING CLIPS DIRECTLY TO FRAMING. USE 0.131X 2 1/2" NAILS WHERE INSTALLED OVER SHEATHING. USE A35 OR RBC CLIPS IN LIEU OF LTP'S FOR ROOF BLOCKING TO TOP PLATE.
- (f) LTP'S ARE NOT REQUIRED WHERE THE LOWER WALL SHEATHING IS OVERLAPPED ONTO THE RIM JOIST A MINIMUM OF 1 1/2" AND NAILED TO THE RIM JOIST PER THE SHEAR WALL PERIMETER NAIL SPACING. LTP'S MAY BE SUBSTITUTED W/ A35'S.
- (g) CONTINUOUS SHEATHING IS REQUIRED OVER THE BOTTOM PLATE TO THE BOTTOM OF THE RIM JOIST OR SILL PLATE WITH EDGE NAILING AT EACH. WHERE TWO ROWS OF NAILING ARE REQUIRED AT RAISED FLOORS, PROVIDE BLOCKING PER PLAN, AND ATTACH WITH LTP4 PER SCHEDULE.
- (h) ANCHOR BOLTS SHALL BE PROVIDED WITH STEEL PLATE WASHERS 0.229"x3"x3". EMBED ANCHOR BOLTS MINIMUM 7" INTO THE CONCRETE. PLATE WASHERS SHALL EXTEND TO WITHIN 1/2" OF THE SILL PLATE EDGE ON THE SHEATHED WALL FACE.
- (i) PRESSURE TREATED MATERIALS CAN CAUSE EXCESSIVE CORROSION IN THE FASTENERS. PROVIDE HOT-DIPPED GALVANIZED (ELECTROPLATING IS NOT ACCEPTABLE) NAILS AND CONNECTOR PLATES (FRAMING ANGLES, ETC.) FOR ALL CONNECTORS IN CONTACT WITH PRESSURE TREATED FRAMING MEMBERS.
- (j) ALL SHEAR WALL STUDS MUST BE SPACED NO MORE THAN 16" O.C.
- (k) 3x MEMBERS MAY BE SUBSTITUTED WITH 2 STUDS NAILED TOGETHER PER TYPICAL BUILT-UP COLUMN DETAIL (SEE DETAILS).

- NOTES:
- UNLESS SPECIFIED ON PLANS, ALL EXTERIOR WALL SHALL BE SHEAR WALL W1, SEE SHEAR WALL TABLE ON THIS SHEET.
 - SEE 1/S4.4 FOR REINFORCED SHEAR WALL DETAIL.

LEVEL 1 SHEAR WALL PLAN
 1/4" = 1'-0"

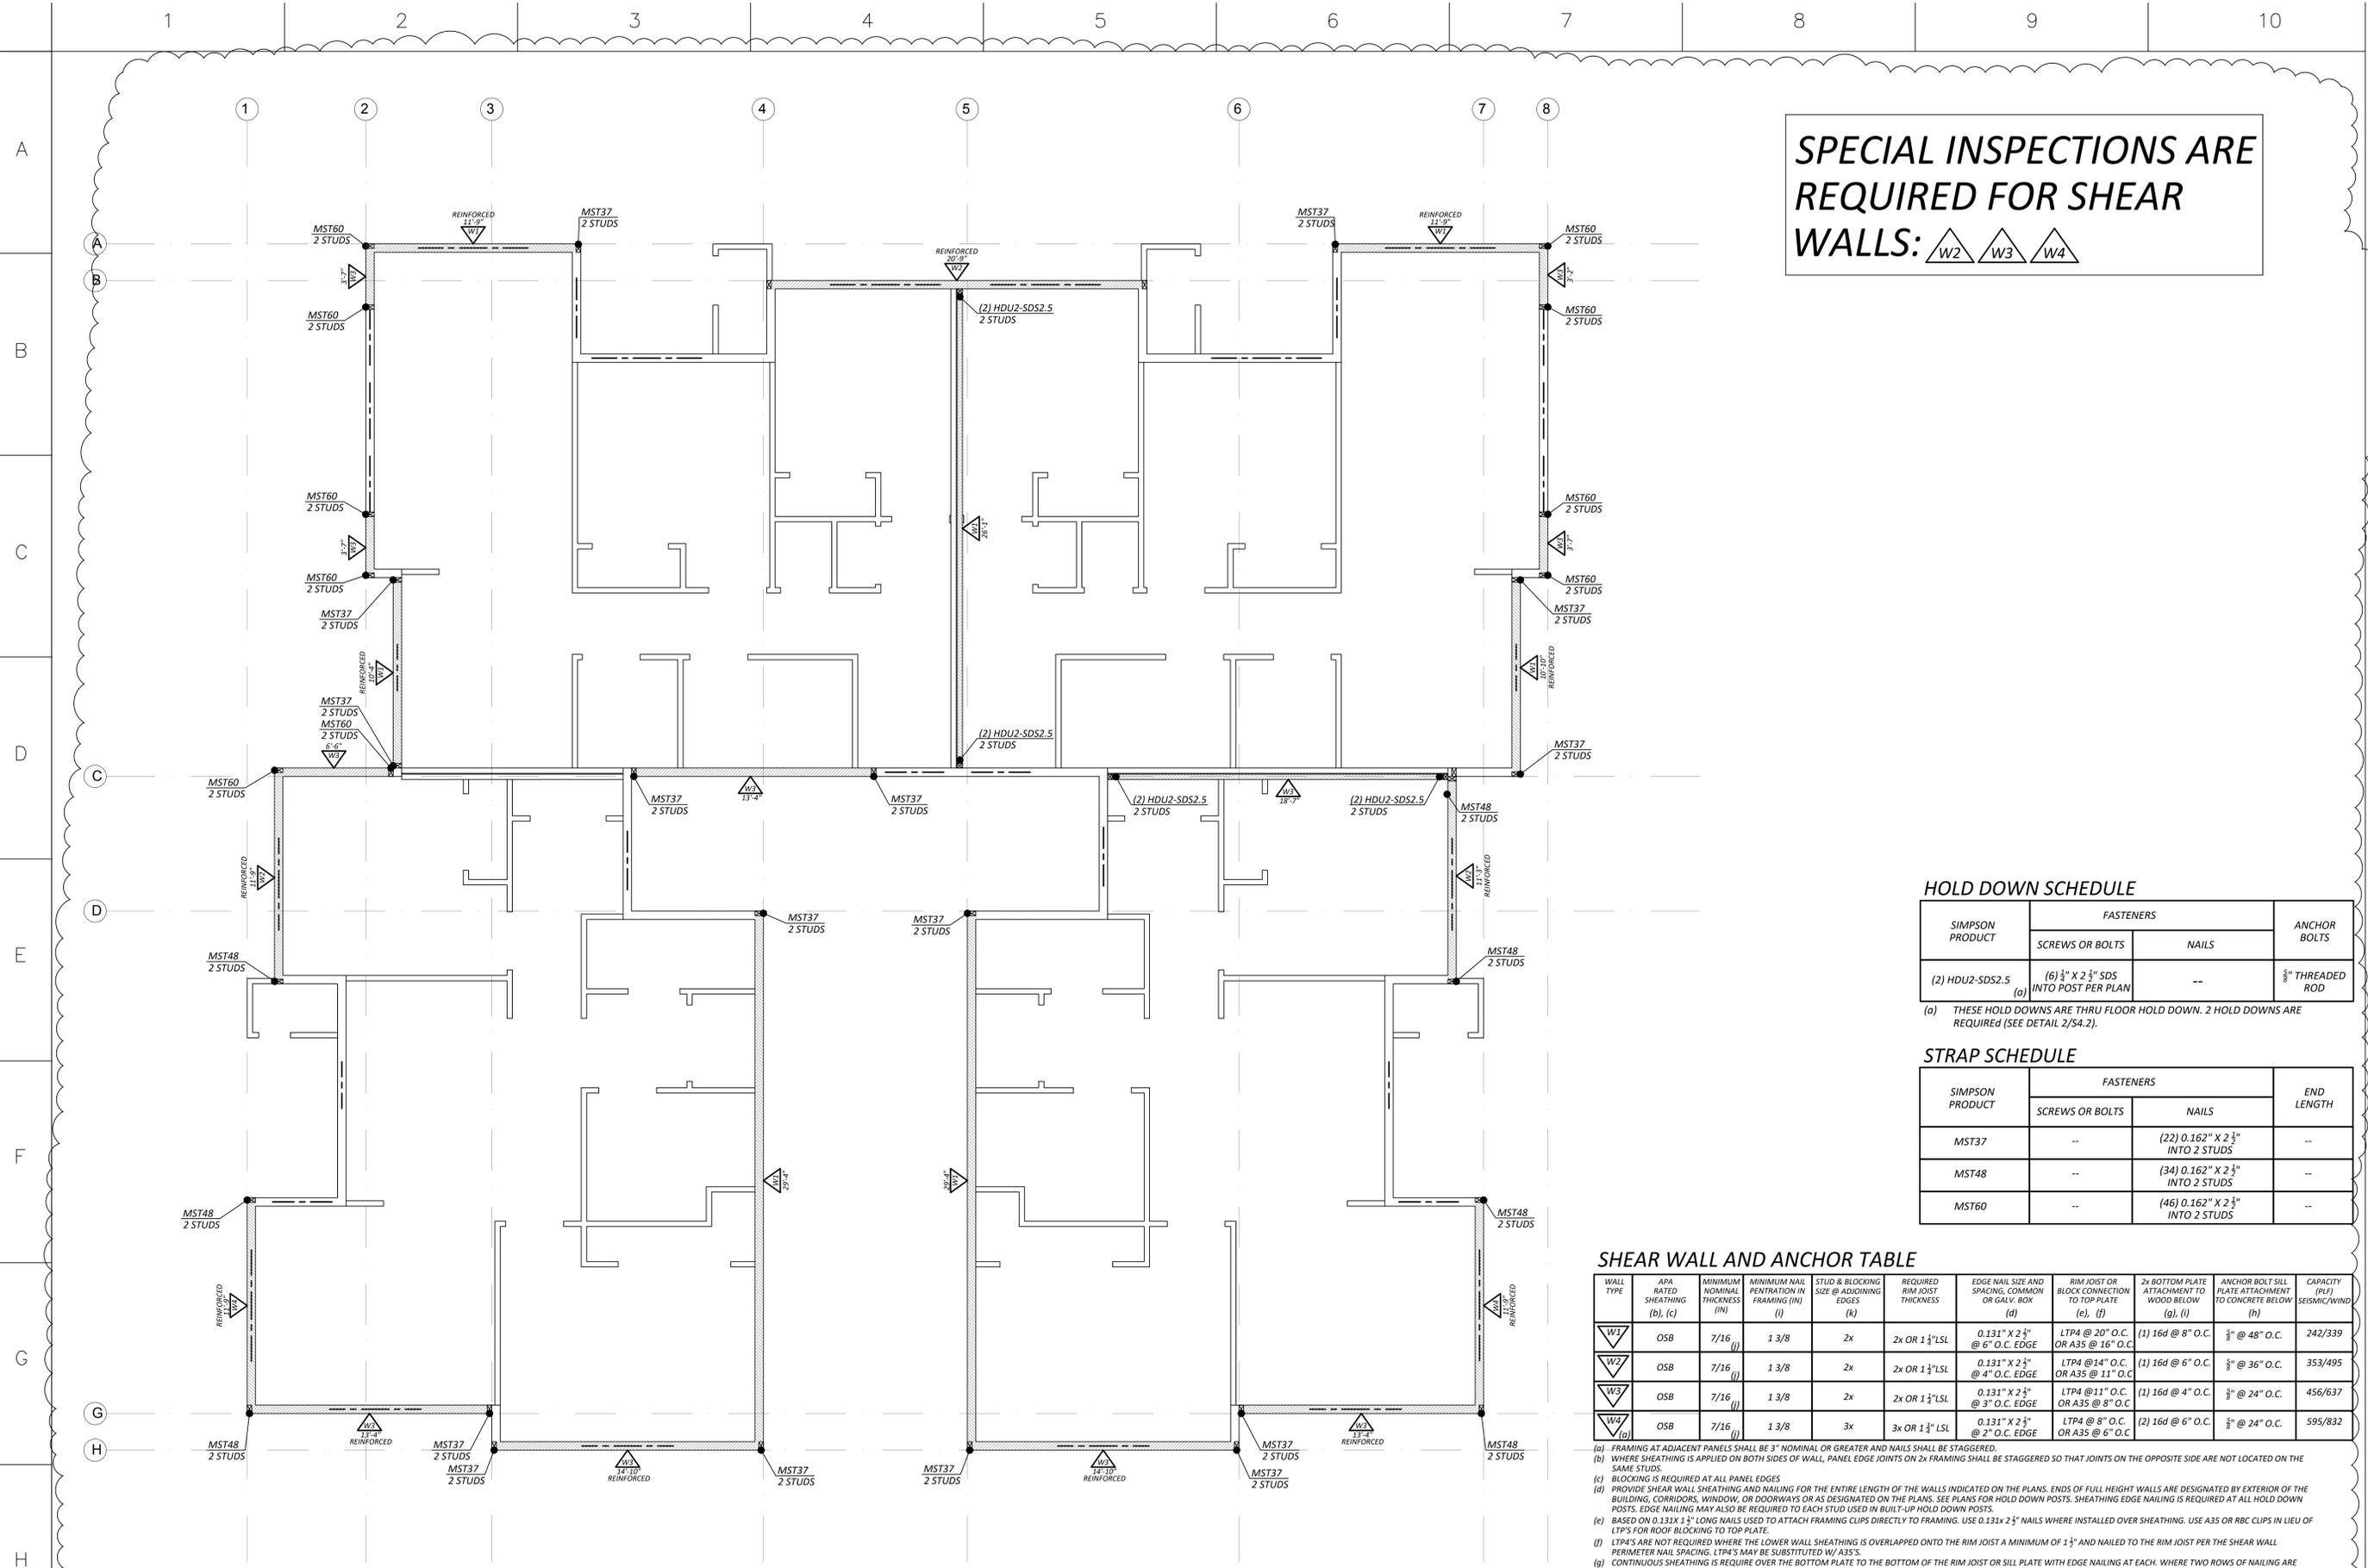

SPECIAL INSPECTIONS ARE REQUIRED FOR SHEAR WALLS: W2, W3, W4

HOLD DOWN SCHEDULE

SIMPSON PRODUCT	FASTENERS		ANCHOR BOLTS
	SCREWS OR BOLTS	NAILS	
(2) HDU2-SDS2.5 (a)	(6) 1/4" X 2 1/2" SDS INTO POST PER PLAN	--	3/8" THREADED ROD

(a) THESE HOLD DOWNS ARE THRU FLOOR HOLD DOWN. 2 HOLD DOWNS ARE REQUIRED (SEE DETAIL 2/S4.2).

STRAP SCHEDULE

SIMPSON PRODUCT	FASTENERS		END LENGTH
	SCREWS OR BOLTS	NAILS	
MST37	--	(22) 0.162" X 2 1/4" INTO 2 STUDS	--
MST48	--	(34) 0.162" X 2 1/4" INTO 2 STUDS	--
MST60	--	(46) 0.162" X 2 1/4" INTO 2 STUDS	--

SHEAR WALL AND ANCHOR TABLE

WALL TYPE	APA RATED SHEATHING (b), (c)	MINIMUM NOMINAL THICKNESS (IN)	MINIMUM NAIL PENETRATION IN FRAMING (IN)	STUD & BLOCKING SIZE @ ADJOINING EDGES (k)	REQUIRED RIM JOIST THICKNESS	EDGE NAIL SIZE AND SPACING, COMMON OR GALV. BOX (d)	RIM JOIST OR BLOCK CONNECTION TO TOP PLATE (e), (f)	2x BOTTOM PLATE ATTACHMENT TO WOOD BELOW (g), (i)	ANCHOR BOLT SILL PLATE ATTACHMENT TO CONCRETE BELOW (h)	CAPACITY (PLF) SEISMIC/WIND
W1	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/4" LSL	0.131" X 2 1/4" @ 6" O.C. EDGE	LTP4 @ 20" O.C. OR A35 @ 16" O.C.	(1) 16d @ 8" O.C.	5/8" @ 48" O.C.	242/339
W2	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/4" LSL	0.131" X 2 1/4" @ 4" O.C. EDGE	LTP4 @ 14" O.C. OR A35 @ 11" O.C.	(1) 16d @ 6" O.C.	5/8" @ 36" O.C.	353/495
W3	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/4" LSL	0.131" X 2 1/4" @ 3" O.C. EDGE	LTP4 @ 11" O.C. OR A35 @ 8" O.C.	(1) 16d @ 4" O.C.	5/8" @ 24" O.C.	456/637
W4	OSB	7/16 (j)	1 3/8	3x	3x OR 1 1/4" LSL	0.131" X 2 1/4" @ 2" O.C. EDGE	LTP4 @ 8" O.C. OR A35 @ 6" O.C.	(2) 16d @ 6" O.C.	5/8" @ 24" O.C.	595/832

- (a) FRAMING AT ADJACENT PANELS SHALL BE 3" NOMINAL OR GREATER AND NAILS SHALL BE STAGGERED.
- (b) WHERE SHEATHING IS APPLIED ON BOTH SIDES OF WALL, PANEL EDGE JOINTS ON 2x FRAMING SHALL BE STAGGERED SO THAT JOINTS ON THE OPPOSITE SIDE ARE NOT LOCATED ON THE SAME STUDS.
- (c) BLOCKING IS REQUIRED AT ALL PANEL EDGES.
- (d) PROVIDE SHEAR WALL SHEATHING AND NAILING FOR THE ENTIRE LENGTH OF THE WALLS INDICATED ON THE PLANS. ENDS OF FULL HEIGHT WALLS ARE DESIGNATED BY EXTERIOR OF THE BUILDING, CORRIDORS, WINDOW, OR DOORWAYS OR AS DESIGNATED ON THE PLANS. SEE PLANS FOR HOLD DOWN POSTS. SHEATHING EDGE NAILING IS REQUIRED AT ALL HOLD DOWN POSTS. EDGE NAILING MAY ALSO BE REQUIRED TO EACH STUD USED IN BUILT-UP HOLD DOWN POSTS.
- (e) BASED ON 0.131X 1 1/4" LONG NAILS USED TO ATTACH FRAMING CLIPS DIRECTLY TO FRAMING. USE 0.131X 2 1/4" NAILS WHERE INSTALLED OVER SHEATHING. USE A35 OR RBC CLIPS IN LIEU OF LTP'S FOR ROOF BLOCKING TO TOP PLATE.
- (f) LTP4'S ARE NOT REQUIRED WHERE THE LOWER WALL SHEATHING IS OVERLAPPED ONTO THE RIM JOIST A MINIMUM OF 1 1/4" AND NAILED TO THE RIM JOIST PER THE SHEAR WALL PERIMETER NAIL SPACING. LTP4'S MAY BE SUBSTITUTED W/ A35'S.
- (g) CONTINUOUS SHEATHING IS REQUIRED OVER THE BOTTOM PLATE TO THE BOTTOM OF THE RIM JOIST OR SILL PLATE WITH EDGE NAILING AT EACH. WHERE TWO ROWS OF NAILING ARE REQUIRED AT RAISED FLOORS, PROVIDE BLOCKING PER PLAN, AND ATTACH WITH LTP4 PER SCHEDULE.
- (h) ANCHOR BOLTS SHALL BE PROVIDED WITH STEEL PLATE WASHERS 0.229"x3"x3". EMBED ANCHOR BOLTS MINIMUM 7" INTO THE CONCRETE. PLATE WASHERS SHALL EXTEND TO WITHIN 4" OF THE SILL PLATE EDGE ON THE SHEATHED WALL FACE.
- (i) PRESSURE TREATED MATERIALS CAN CAUSE EXCESSIVE CORROSION IN THE FASTENERS. PROVIDE HOT-DIPPED GALVANIZED (ELECTROPLATING IS NOT ACCEPTABLE) NAILS AND CONNECTOR PLATES (FRAMING ANGLES, ETC.) FOR ALL CONNECTORS IN CONTACT WITH PRESSURE TREATED FRAMING MEMBERS.
- (j) ALL SHEAR WALL STUDS MUST BE SPACED NO MORE THAN 16" O.C.
- (k) 3x MEMBERS MAY BE SUBSTITUTED WITH 2 STUDS NAILED TOGETHER PER TYPICAL BUILT-UP COLUMN DETAIL (SEE DETAILS).

NOTES:
 1. UNLESS SPECIFIED ON PLANS, ALL EXTERIOR WALL SHALL BE SHEAR WALL W1, SEE SHEAR WALL TABLE ON THIS SHEET.
 2. SEE 1/S4.4 FOR REINFORCED SHEAR WALL DETAIL.

LEVEL 2 SHEAR WALL PLAN
 1/4" = 1'-0"

PIERUCCIONI E&C, LLC
 CHON PIERUCCIONI, PE
 3128 N. BENNETT ST. TACOMA, WA 98407
 PIERUCCIONENGINEERING@GMAIL.COM
 206.940.7860

PRGA20250487

City of Puyallup
 Development & Permitting Services
ISSUED PERMIT

Building	Planning
Engineering	Public Works
Fire	Traffic

EAST TOWN CROSSING
 BUILDING 'A'
 PIONEER & SHAW PUYALLUP WA

REVISIONS


NO.	REVISION	DATE
01	REVIEW 1	2024.08.05

REVISIONS

NO.	REVISION	DATE

DRAWN BY: CP
 CHECKED BY: CP
 DATE: 2023.03.05
 TITLE: SHEAR WALL PLAN
 PROJECT #: ---
 SHEET: ---

S3.7

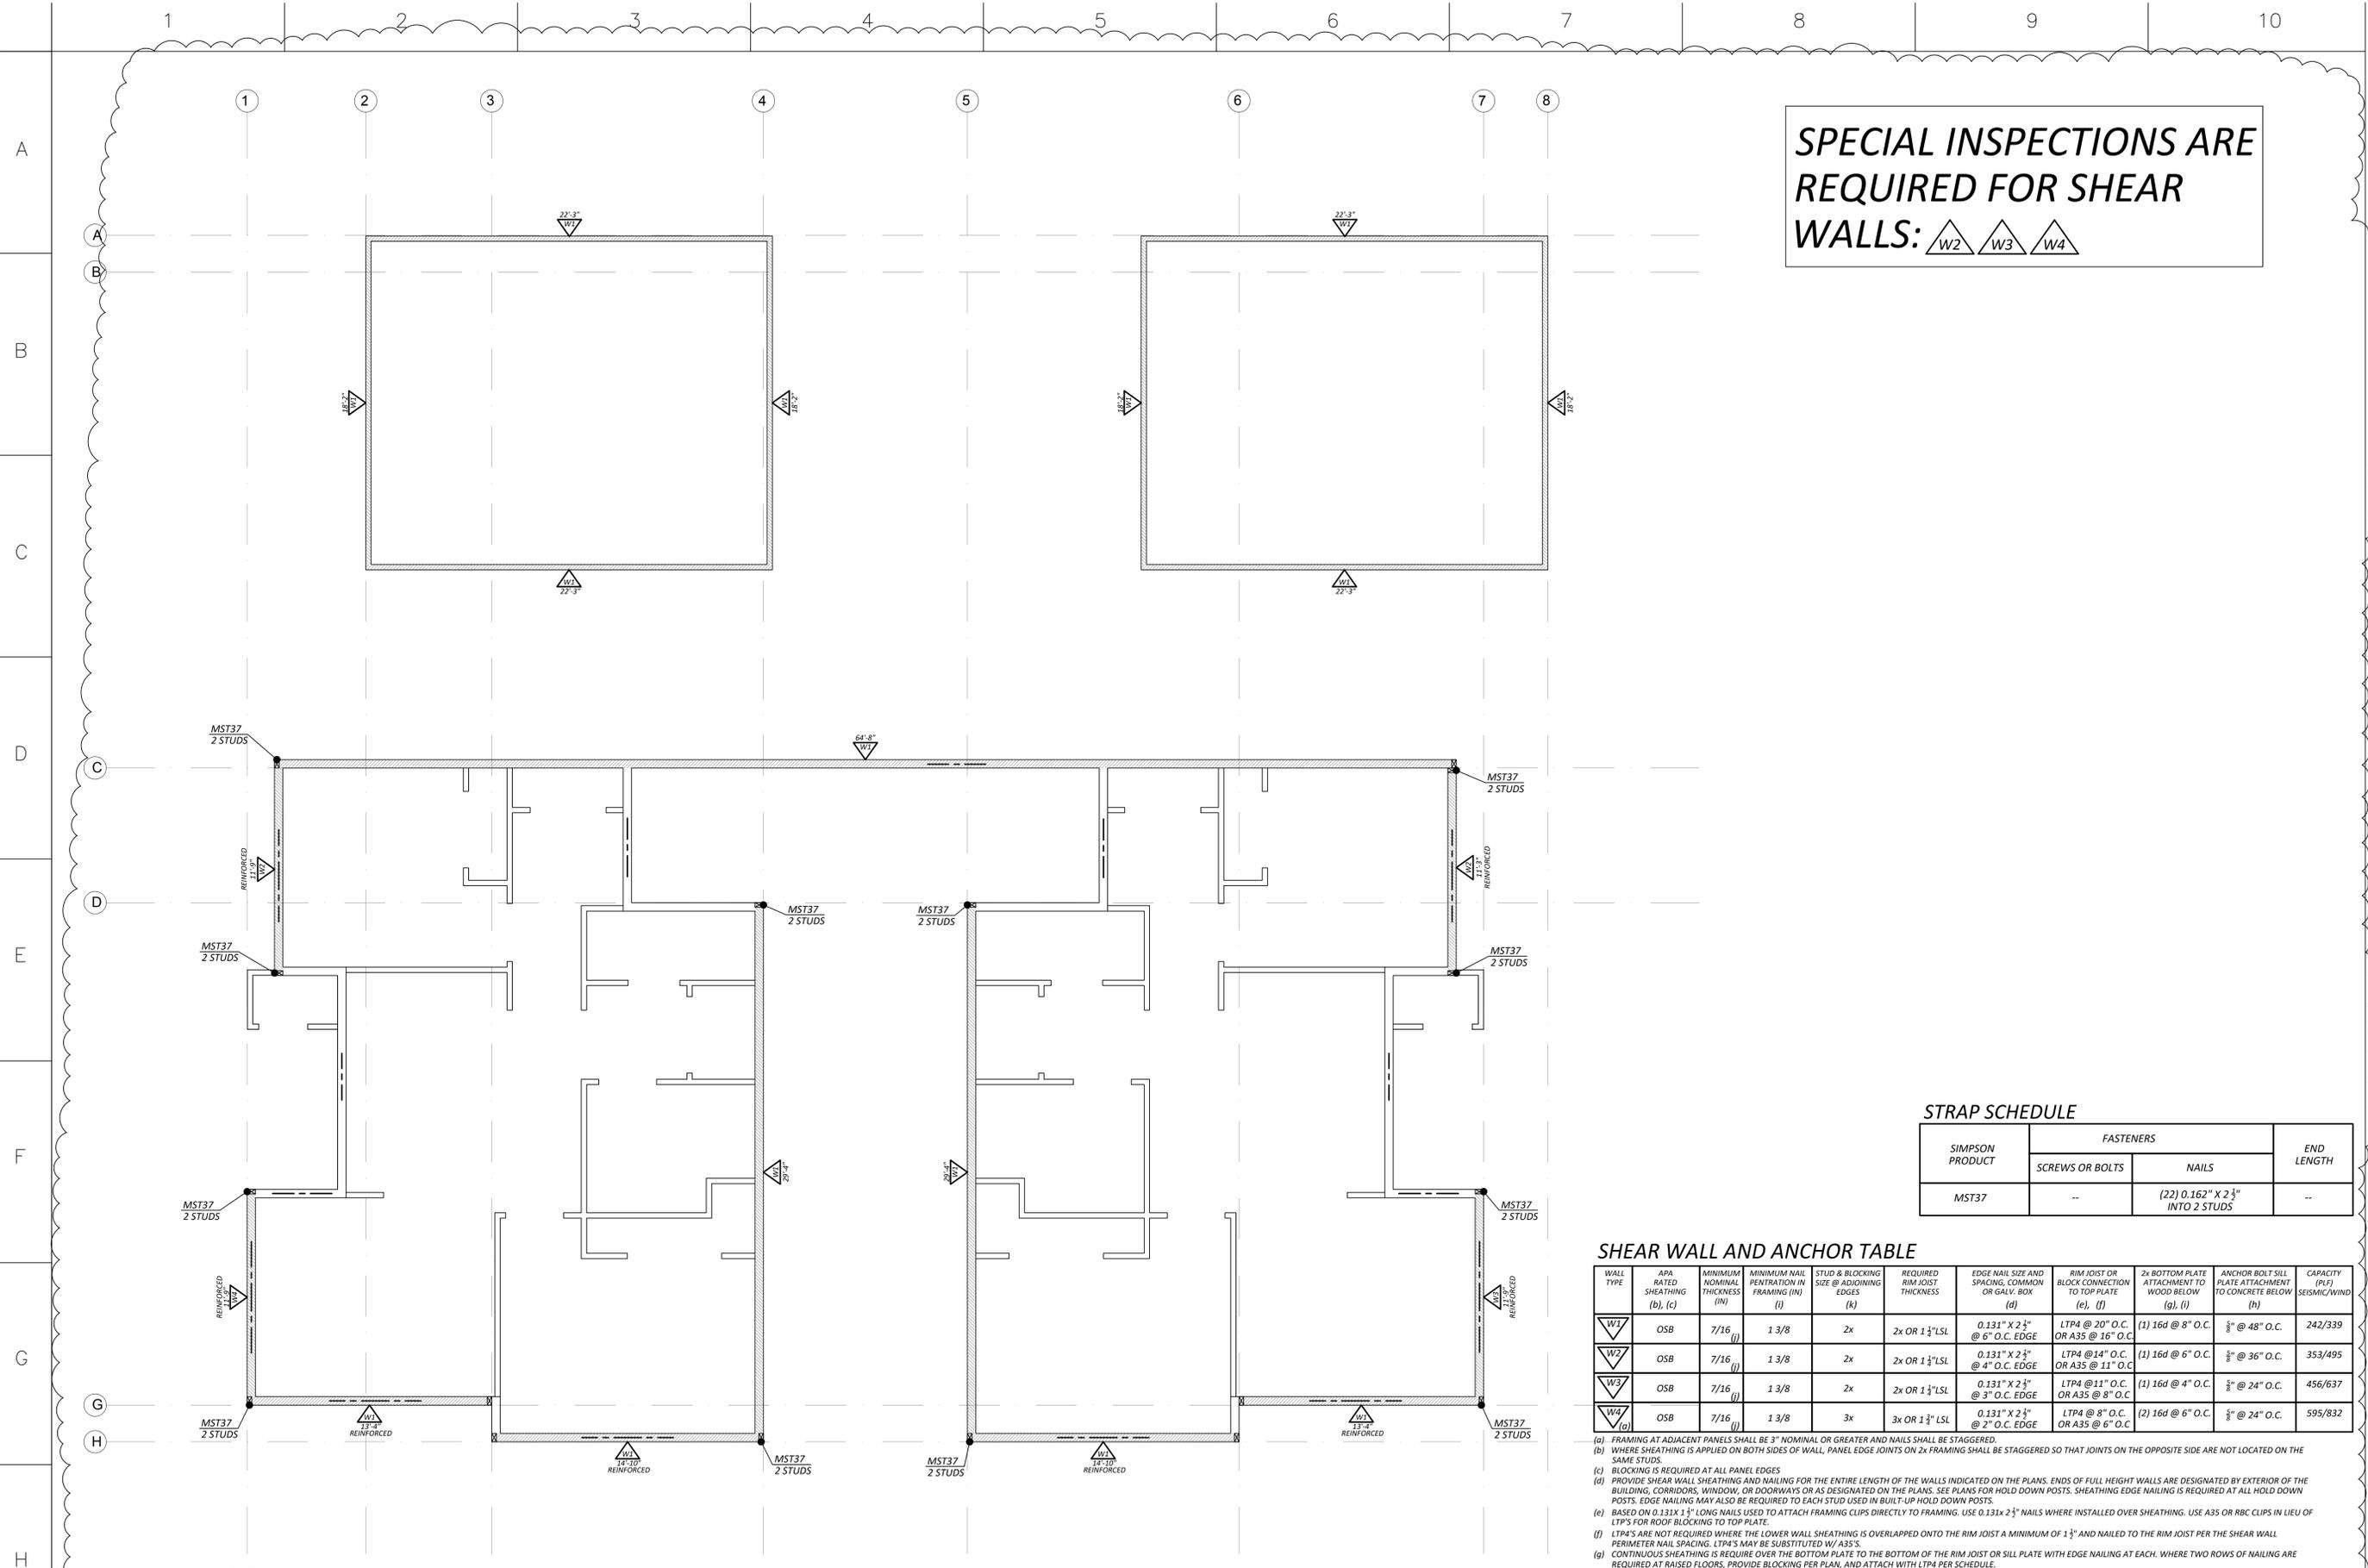

SPECIAL INSPECTIONS ARE REQUIRED FOR SHEAR WALLS: $\triangle W2$ $\triangle W3$ $\triangle W4$

STRAP SCHEDULE

SIMPSON PRODUCT	FASTENERS		END LENGTH
	SCREWS OR BOLTS	NAILS	
MST37	--	(22) 0.162" X 2 1/8" INTO 2 STUDS	--

SHEAR WALL AND ANCHOR TABLE

WALL TYPE	APA RATED SHEATHING (b), (c)	MINIMUM NOMINAL THICKNESS (N)	MINIMUM NAIL PENETRATION IN FRAMING (IN) (I)	STUD & BLOCKING SIZE @ ADJOINING EDGES (k)	REQUIRED RIM JOIST THICKNESS	EDGE NAIL SIZE AND SPACING, COMMON OR GALV. BOX (d)	RIM JOIST OR BLOCK CONNECTION TO TOP PLATE (e), (f)	2x BOTTOM PLATE ATTACHMENT TO WOOD BELOW (g), (i)	ANCHOR BOLT SILL PLATE ATTACHMENT TO CONCRETE BELOW (h)	CAPACITY (PLF) SEISMIC/WIND
W1	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/4" LSL	0.131" X 2 1/4" @ 6" O.C. EDGE	LTP4 @ 20" O.C. OR A35 @ 16" O.C.	(1) 16d @ 8" O.C.	80# @ 48" O.C.	242/339
W2	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/4" LSL	0.131" X 2 1/4" @ 4" O.C. EDGE	LTP4 @ 14" O.C. OR A35 @ 11" O.C.	(1) 16d @ 6" O.C.	80# @ 36" O.C.	353/495
W3	OSB	7/16 (j)	1 3/8	2x	2x OR 1 1/4" LSL	0.131" X 2 1/4" @ 3" O.C. EDGE	LTP4 @ 11" O.C. OR A35 @ 8" O.C.	(1) 16d @ 4" O.C.	80# @ 24" O.C.	456/637
W4	OSB	7/16 (j)	1 3/8	3x	3x OR 1 3/4" LSL	0.131" X 2 1/4" @ 2" O.C. EDGE	LTP4 @ 8" O.C. OR A35 @ 6" O.C.	(2) 16d @ 6" O.C.	80# @ 24" O.C.	595/832

- (j) FRAMING AT ADJACENT PANELS SHALL BE 3" NOMINAL OR GREATER AND NAILS SHALL BE STAGGERED.
- (k) WHERE SHEATHING IS APPLIED ON BOTH SIDES OF WALL, PANEL EDGE JOINTS ON 2x FRAMING SHALL BE STAGGERED SO THAT JOINTS ON THE OPPOSITE SIDE ARE NOT LOCATED ON THE SAME STUDS.
- (l) BLOCKING IS REQUIRED AT ALL PANEL EDGES.
- (m) PROVIDE SHEAR WALL SHEATHING AND NAILING FOR THE ENTIRE LENGTH OF THE WALLS INDICATED ON THE PLANS. ENDS OF FULL HEIGHT WALLS ARE DESIGNATED BY EXTERIOR OF THE BUILDING, CORRIDORS, WINDOW, OR DOORWAYS OR AS DESIGNATED ON THE PLANS. SEE PLANS FOR HOLD DOWN POSTS. SHEATHING EDGE NAILING IS REQUIRED AT ALL HOLD DOWN POSTS. EDGE NAILING MAY ALSO BE REQUIRED TO EACH STUD USED IN BUILT-UP HOLD DOWN POSTS.
- (n) BASED ON 0.131x 1 1/4" LONG NAILS USED TO ATTACH FRAMING CLIPS DIRECTLY TO FRAMING. USE 0.131x 2 1/4" NAILS WHERE INSTALLED OVER SHEATHING. USE A35 OR RBC CLIPS IN LIEU OF LTP'S FOR ROOF BLOCKING TO TOP PLATE.
- (o) LTP4'S ARE NOT REQUIRED WHERE THE LOWER WALL SHEATHING IS OVERLAPPED ONTO THE RIM JOIST A MINIMUM OF 1 1/2" AND NAILED TO THE RIM JOIST PER THE SHEAR WALL PERIMETER NAIL SPACING. LTP4'S MAY BE SUBSTITUTED W/ A35'S.
- (p) CONTINUOUS SHEATHING IS REQUIRED OVER THE BOTTOM PLATE TO THE BOTTOM OF THE RIM JOIST OR SILL PLATE WITH EDGE NAILING AT EACH. WHERE TWO ROWS OF NAILING ARE REQUIRED AT RAISED FLOORS, PROVIDE BLOCKING PER PLAN, AND ATTACH WITH LTP4 PER SCHEDULE.
- (q) ANCHOR BOLTS SHALL BE PROVIDED WITH STEEL PLATE WASHERS 0.229"x3"x3". EMBED ANCHOR BOLTS MINIMUM 7" INTO THE CONCRETE. PLATE WASHERS SHALL EXTEND TO WITHIN 5" OF THE SILL PLATE EDGE ON THE SHEATHED WALL FACE.
- (r) PRESSURE TREATED MATERIALS CAN CAUSE EXCESSIVE CORROSION IN THE FASTENERS. PROVIDE HOT-DIPPED GALVANIZED (ELECTROPLATING IS NOT ACCEPTABLE) NAILS AND CONNECTOR PLATES (FRAMING ANGLES, ETC.) FOR ALL CONNECTORS IN CONTACT WITH PRESSURE TREATED FRAMING MEMBERS.
- (s) ALL SHEAR WALL STUDS MUST BE SPACED NO MORE THAN 16" O.C.
- (t) 3x MEMBERS MAY BE SUBSTITUTED WITH 2 STUDS NAILED TOGETHER PER TYPICAL BUILT-UP COLUMN DETAIL (SEE DETAILS).

- NOTES:**
- UNLESS SPECIFIED ON PLANS, ALL EXTERIOR WALL SHALL BE SHEAR WALL W1, SEE SHEAR WALL TABLE ON THIS SHEET.
 - SEE 1/54.4 FOR REINFORCED SHEAR WALL DETAIL.

LEVEL 3 SHEAR WALL PLAN
1/4" = 1'-0"

PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
3128 N. BENNETT ST. TACOMA, WA 98407
PIERUCCIONIENGINEERING@GMAIL.COM
206.460.7869

PRGA20250487

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building	Planning
Engineering	Public Works
Fire	Traffic

EAST TOWN CROSSING
BUILDING 'A'
PIONEER & SHAW PUYALLUP WA

REVISIONS

NO.	REVISION	DATE
01	REVIEW 1	2024.08.05

REVISIONS

DRAWN BY: CP
CHECKED BY: CP
DATE: 2023.03.05
TITLE: SHEAR WALL PLAN
PROJECT #: ---
SHEET: ---

S3.8



PIERUCCIONI E&C, LLC
 CHON PIERUCCIONI, PE
 3128 N. BENNETT ST. TACOMA, WA 98407
 PIERUCCIONENGINEERING@GMAIL.COM
 252.940.7890

REUSE OF DOCUMENTS
 THIS DOCUMENT AND THE INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF PIERUCCIONI ENGINEERING, LLC. ANY REPRODUCTION OR TRANSMISSION OF THIS DOCUMENT IN WHOLE OR IN PART WITHOUT THE WRITTEN AUTHORIZATION OF PIERUCCIONI ENGINEERING, LLC IS PROHIBITED.

PRGA20250487

City of Puyallup
 Development & Permitting Services
 ISSUED PERMIT

Building	Planning
Engineering	Public Works
Fire	Traffic

EAST TOWN CROSSING
 BUILDING 'A'
 PIONEER & SHAW PUYALLUP WA


REVISIONS

01	REVIEW 1	2024.08.05
----	----------	------------

REVISIONS


DRAWN BY:	CP
CHECKED BY:	CP
DATE:	2023.03.05
TITLE:	SHEAR WALL PLAN
PROJECT #:	----
SHEET:	

S3.9

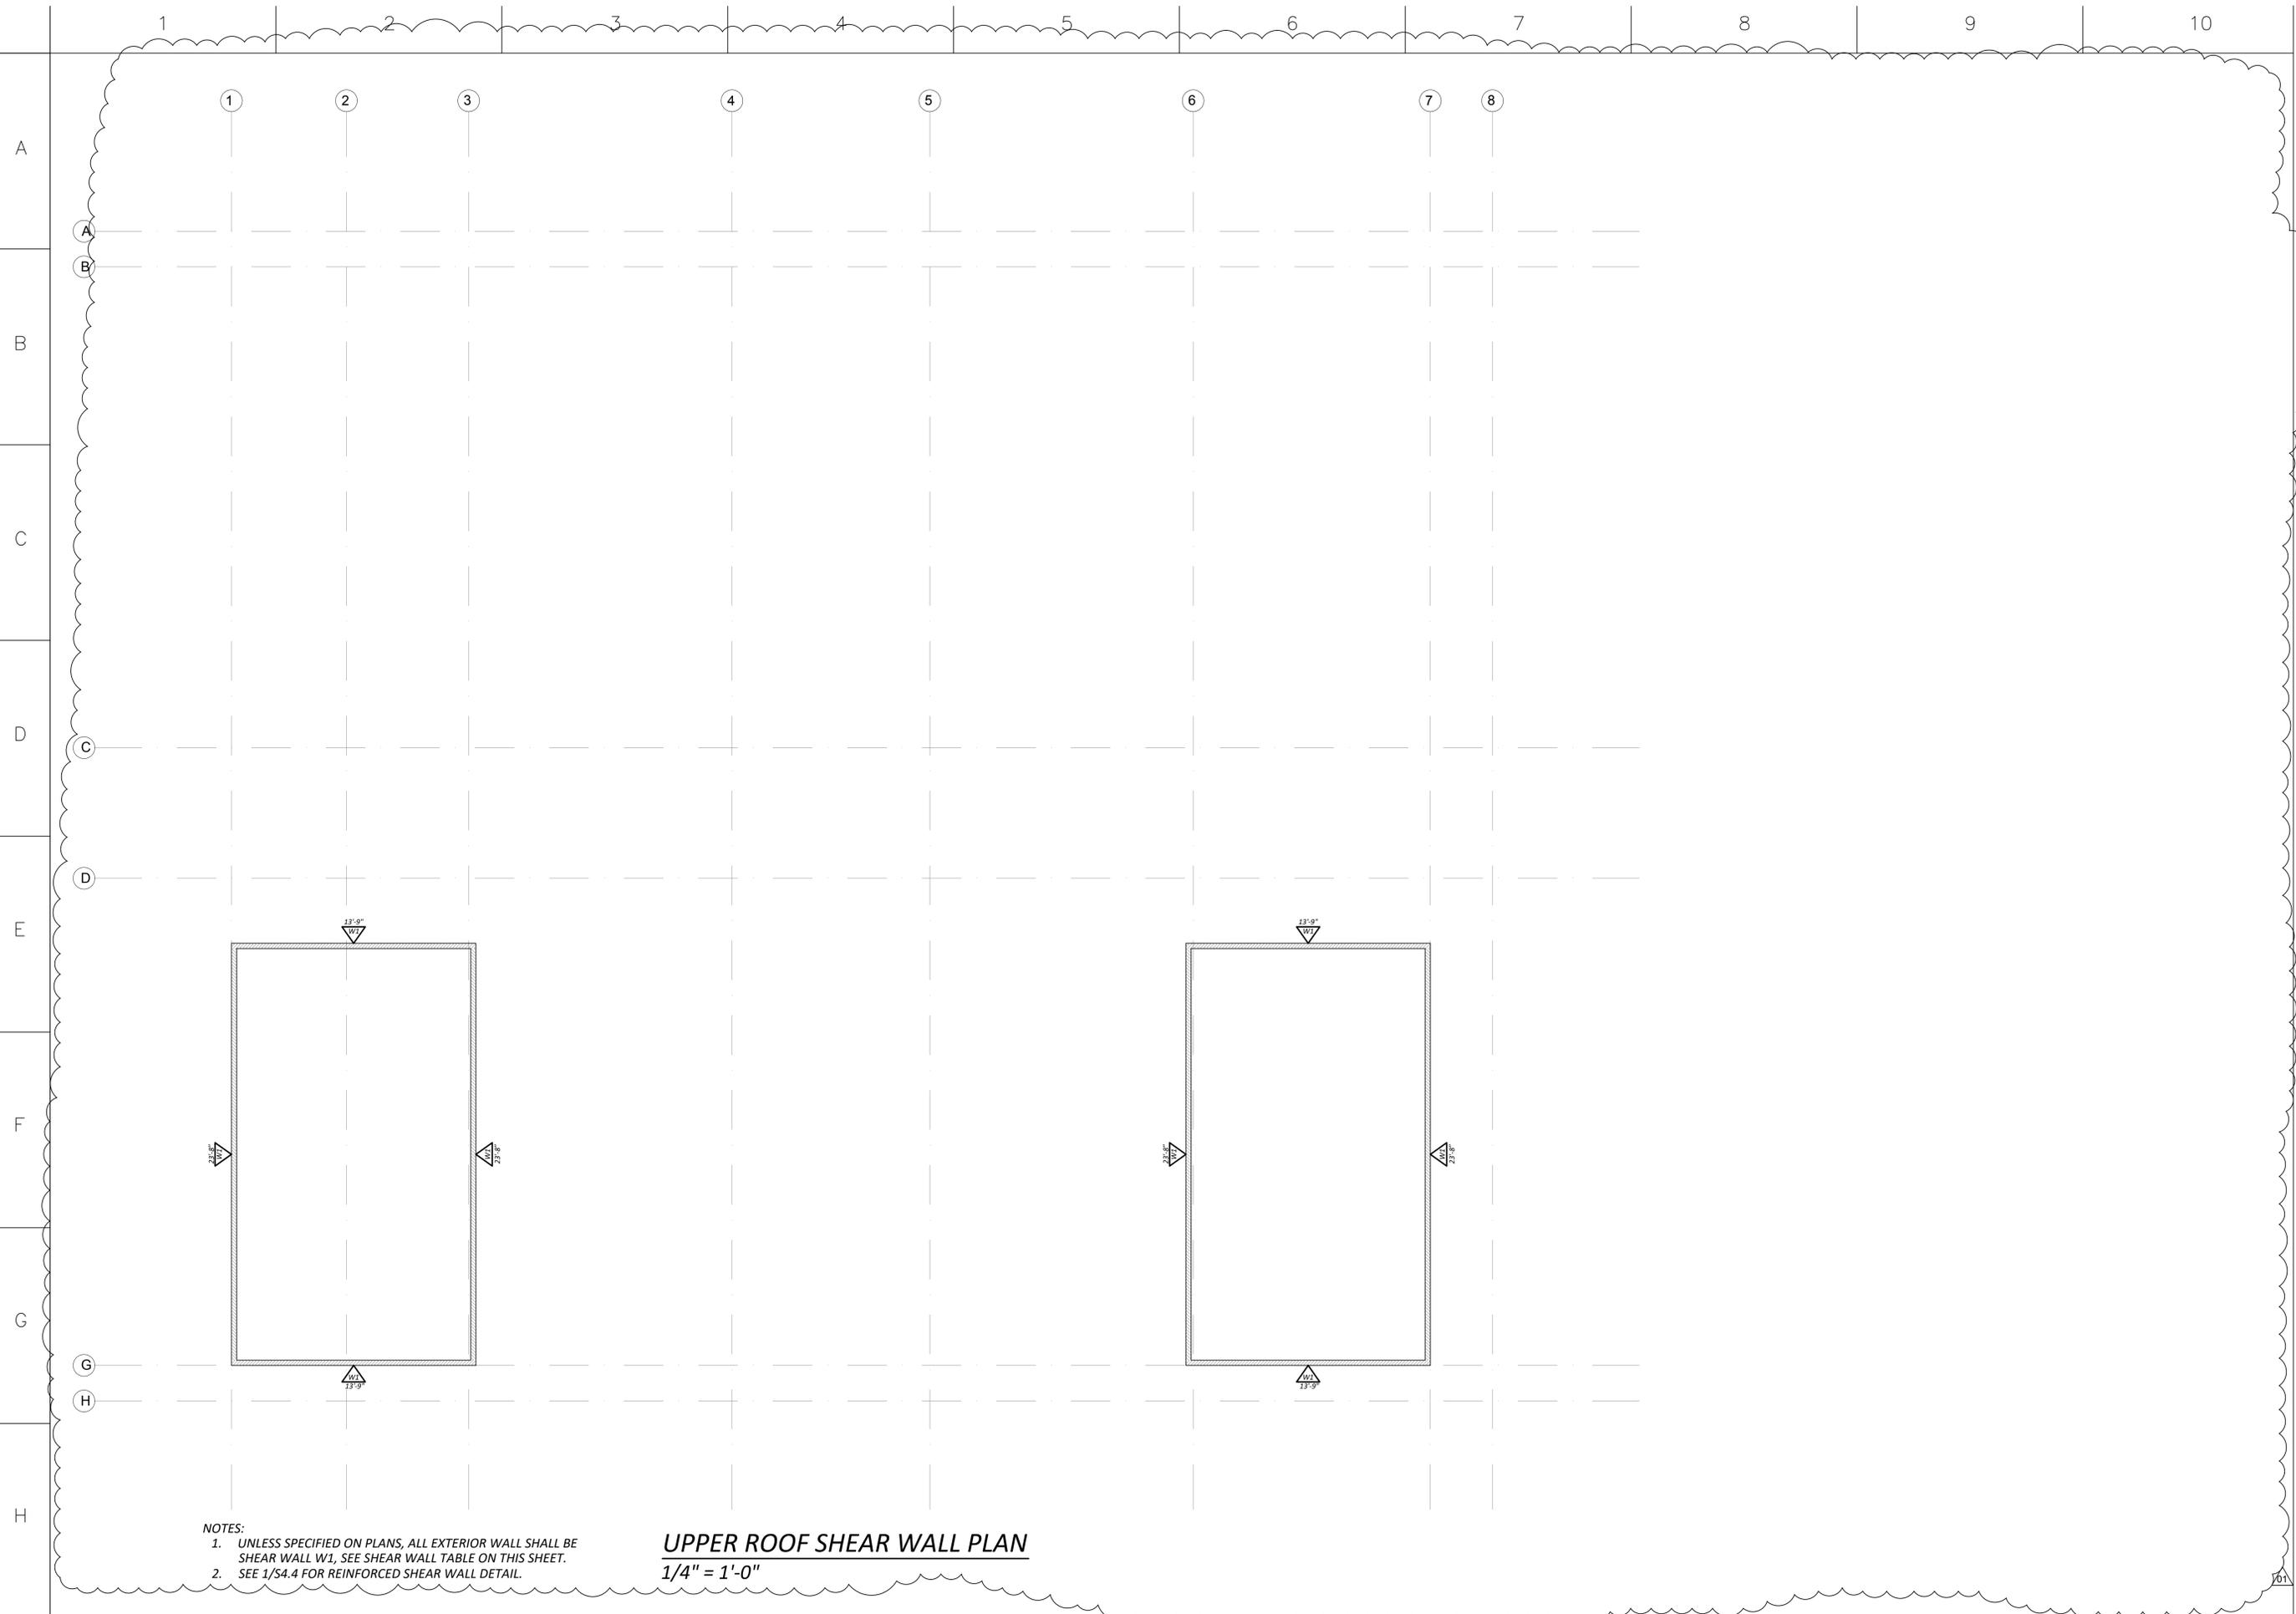

- NOTES:
- UNLESS SPECIFIED ON PLANS, ALL EXTERIOR WALL SHALL BE SHEAR WALL W1, SEE SHEAR WALL TABLE ON THIS SHEET.
 - SEE 1/S4.4 FOR REINFORCED SHEAR WALL DETAIL.

UPPER ROOF SHEAR WALL PLAN
 1/4" = 1'-0"

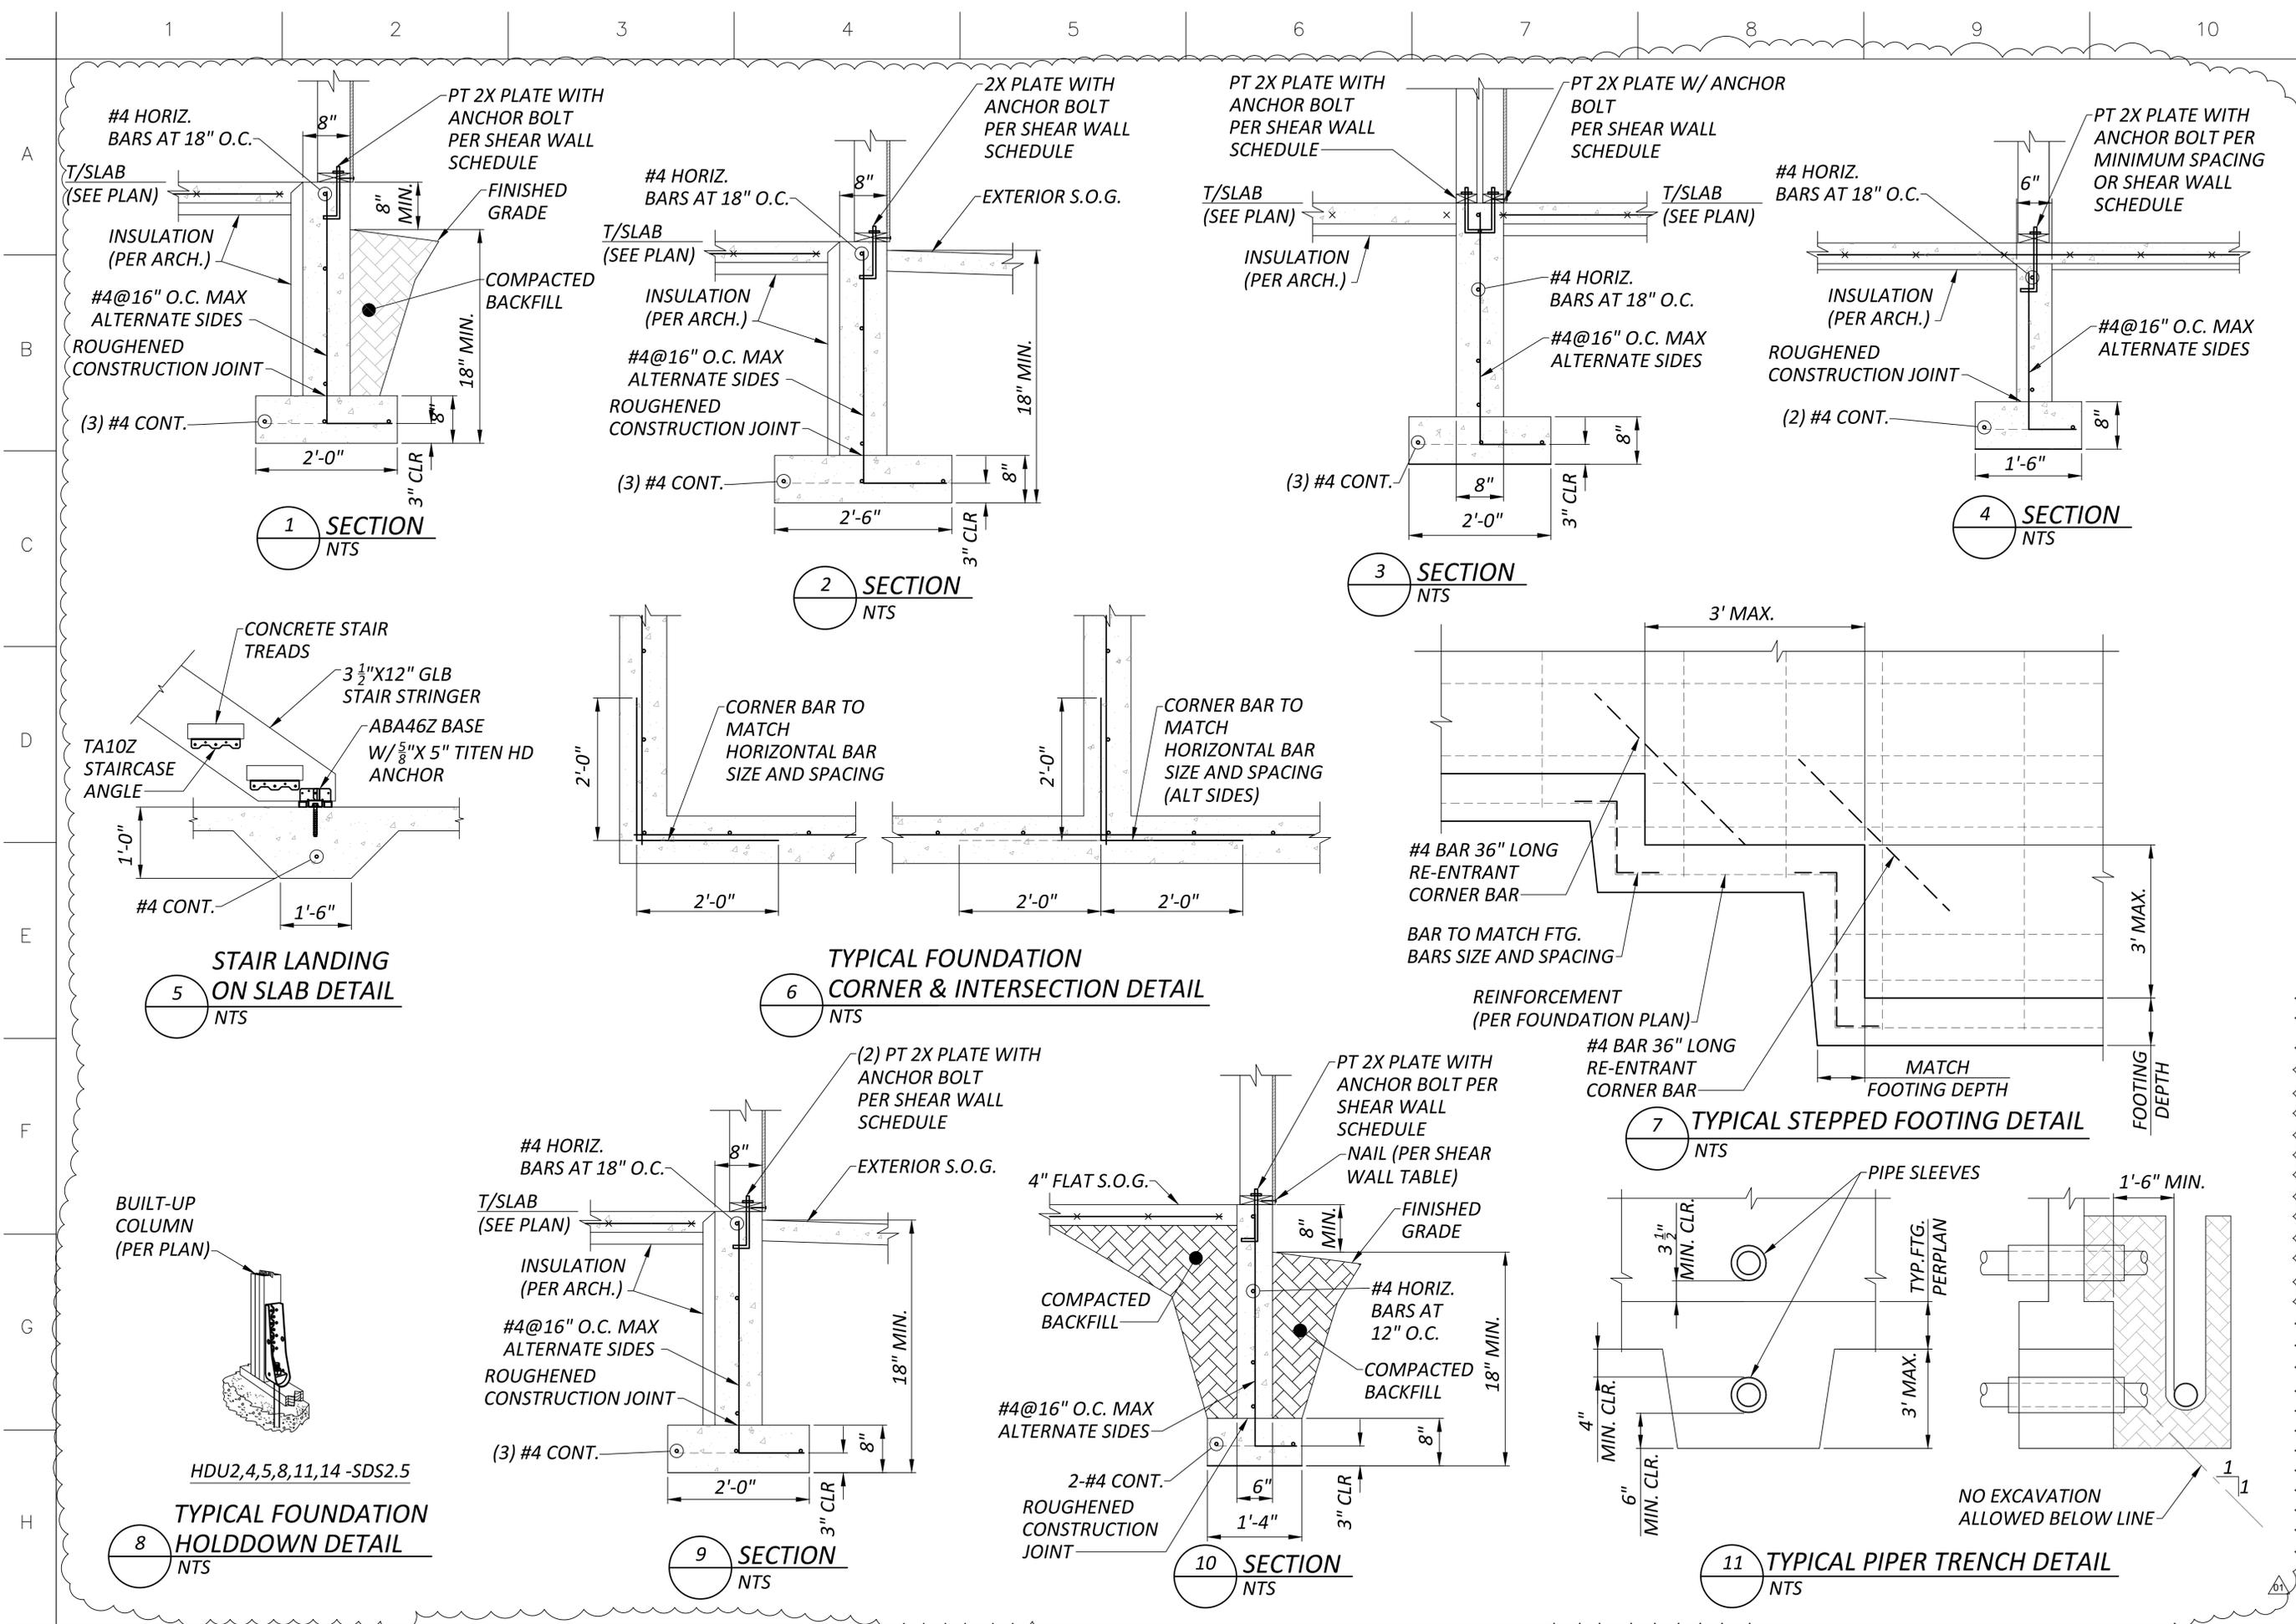

EAST TOWN CROSSING
BUILDING 'A'
PIONEER & SHAW PUYALLUP WA

S4.1

REVISIONS

NO.	DATE	DESCRIPTION
01	2024.08.05	REVIEW 1

REVISIONS

DRAWN BY: CP
 CHECKED BY: CP
 DATE: 2023.03.05
 TITLE: DETAILS
 PROJECT #: ----
 SHEET: ----


PIERUCCIONI E&C, LLC
 CHON PIERUCCIONI, PE
 2101 N. BENNETT ST. TACOMA, WA 98561
 PIERUCCIONIENGINEERING.COM
 206.849.7888

PRGA20250487

City of Puyallup
 Development & Permitting Services
 ISSUED PERMIT

Building Planning
 Engineering Public Works
 Fire Traffic

REUSE OF DOCUMENTS
 THIS DOCUMENT AND THE DESIGN INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF PIERUCCIONI ENGINEERING AND SHALL BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN. ANY REUSE OF THIS DOCUMENT FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF PIERUCCIONI ENGINEERING IS STRICTLY PROHIBITED.

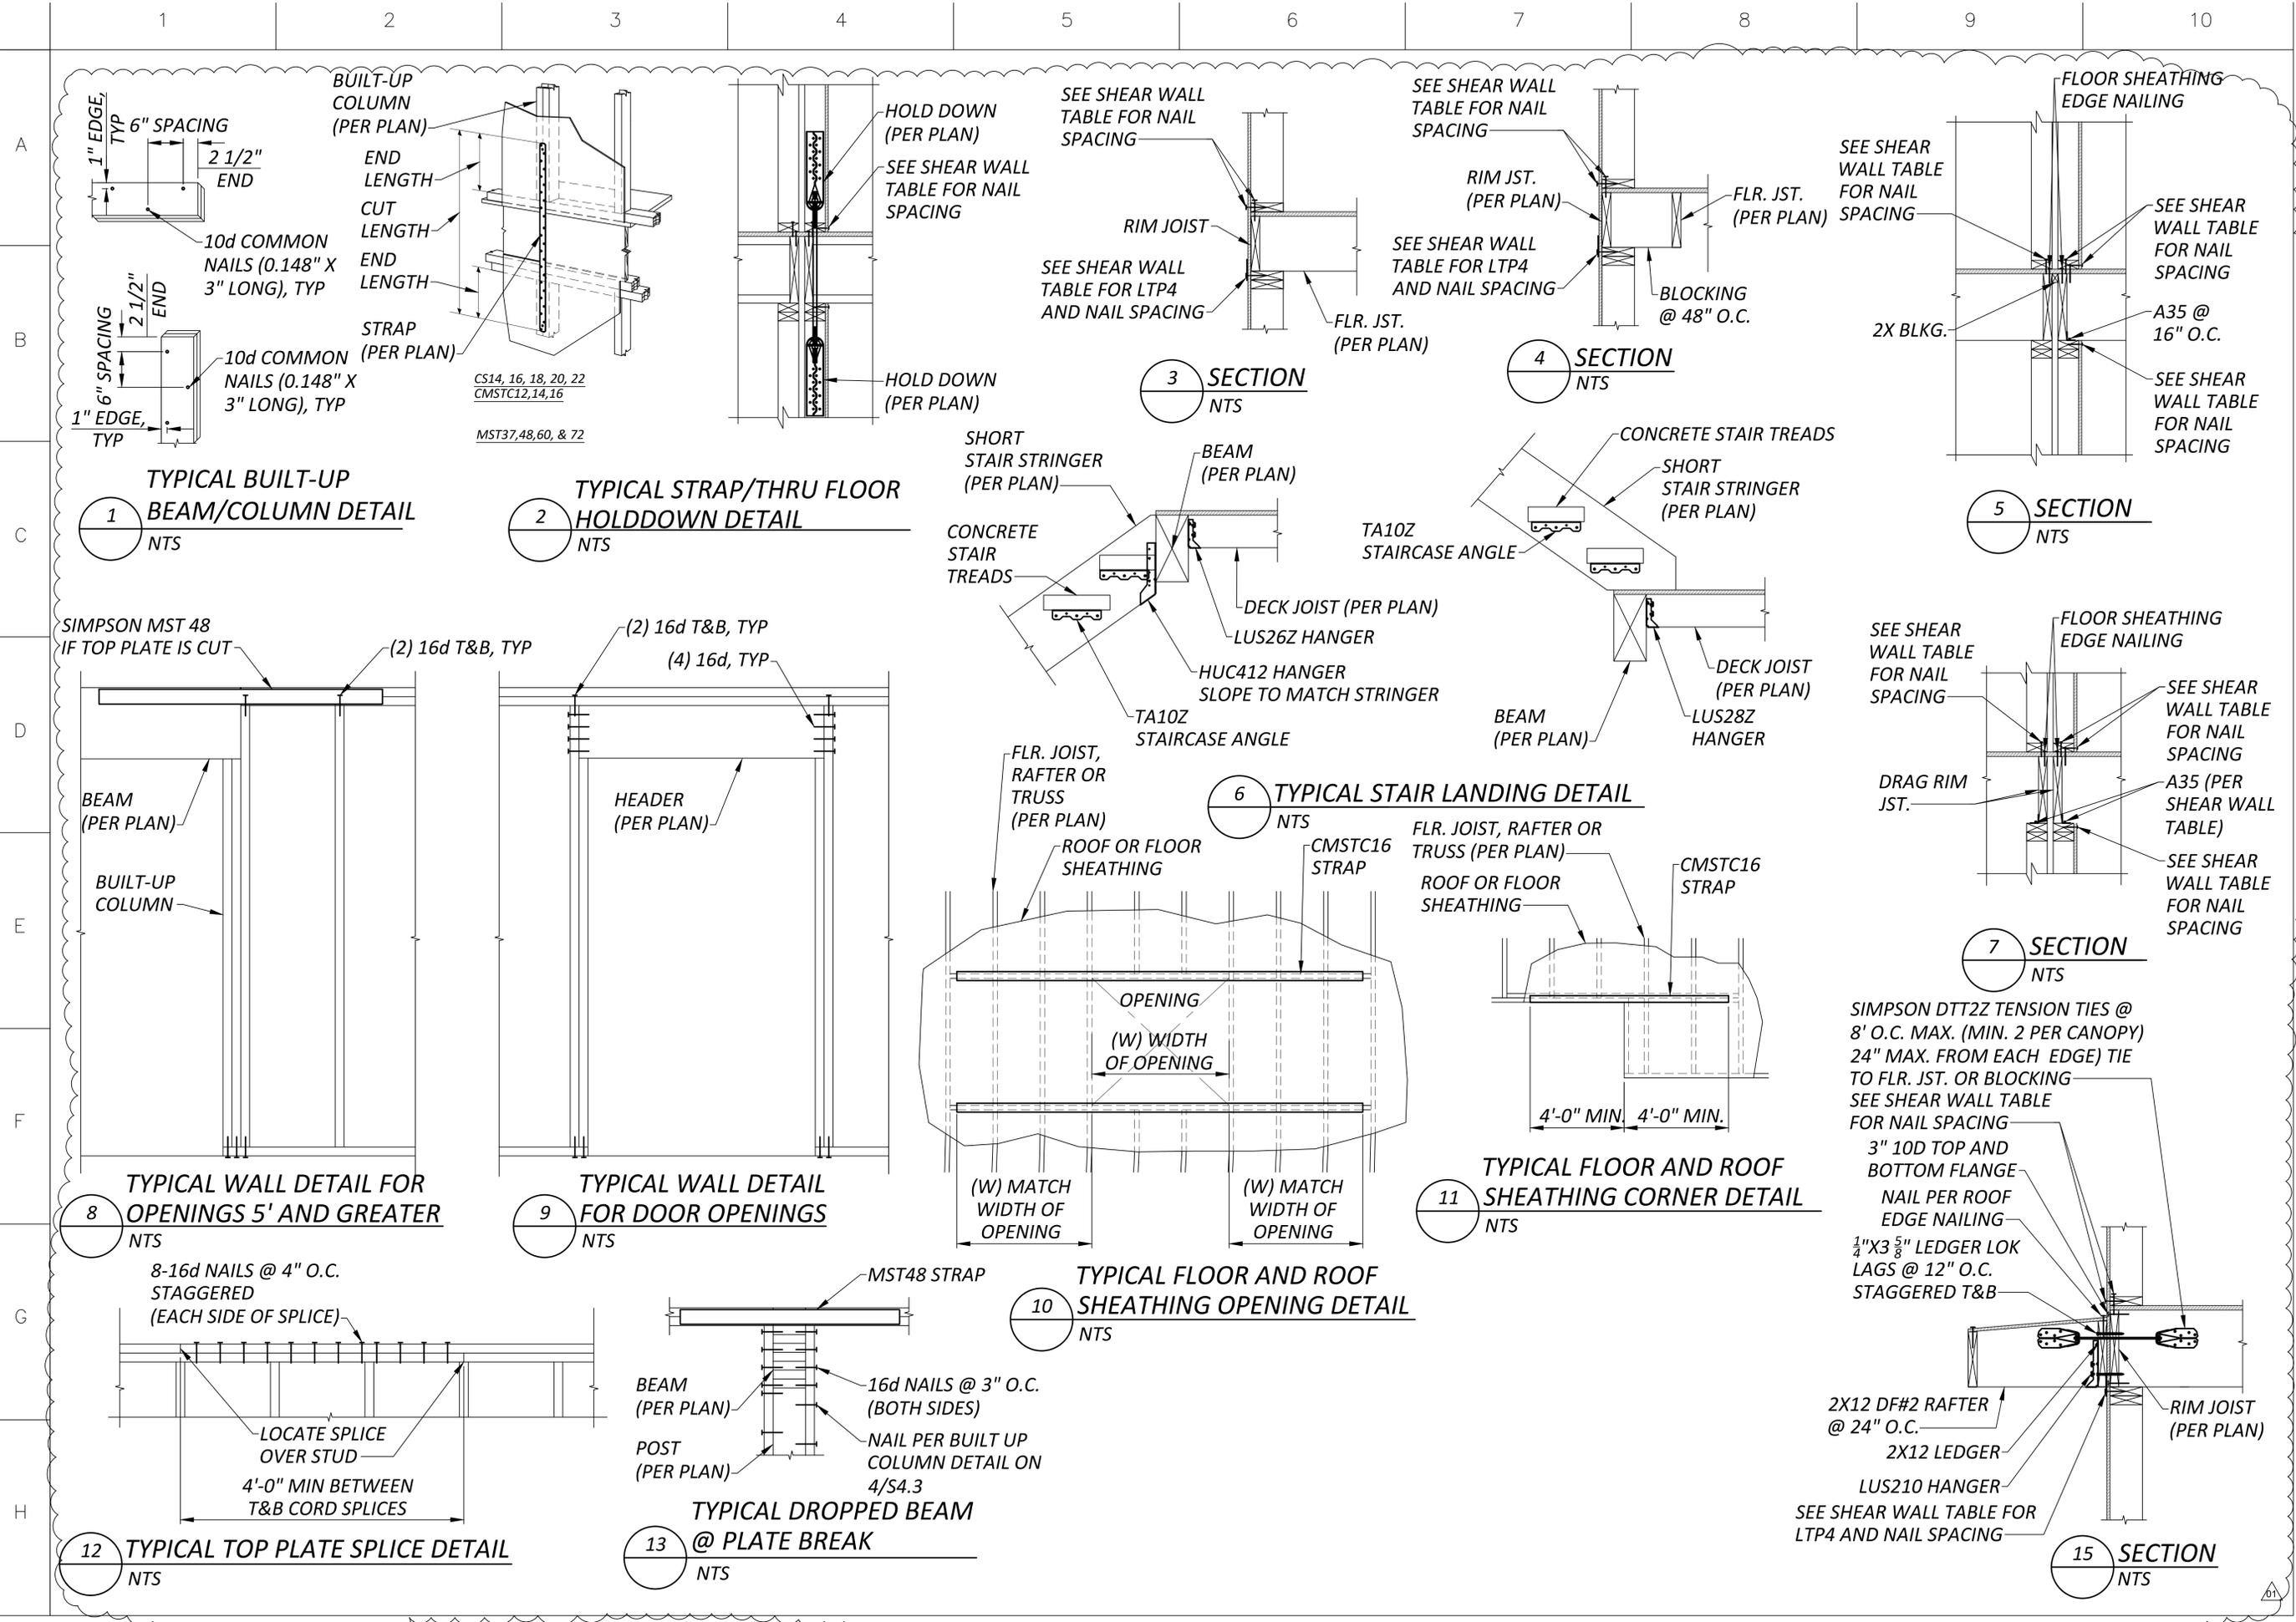

PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
222 N. BENTLEY ST. TACOMA, WA 98402
PIERUCCIONEENGINEERING@GMAIL.COM
206.940.7969

PRGA20250487

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building Planning
Engineering Public Works
Fire Traffic


EAST TOWN CROSSING
BUILDING 'A'
PIONEER & SHAW PUYALLUP WA

REVISIONS	
01	REVIEW 1 2024.08.05

REVISIONS

DRAWN BY: CP
CHECKED BY: CP
DATE: 2023.03.05
TITLE: DETAILS
PROJECT #: ---
SHEET:

S4.2

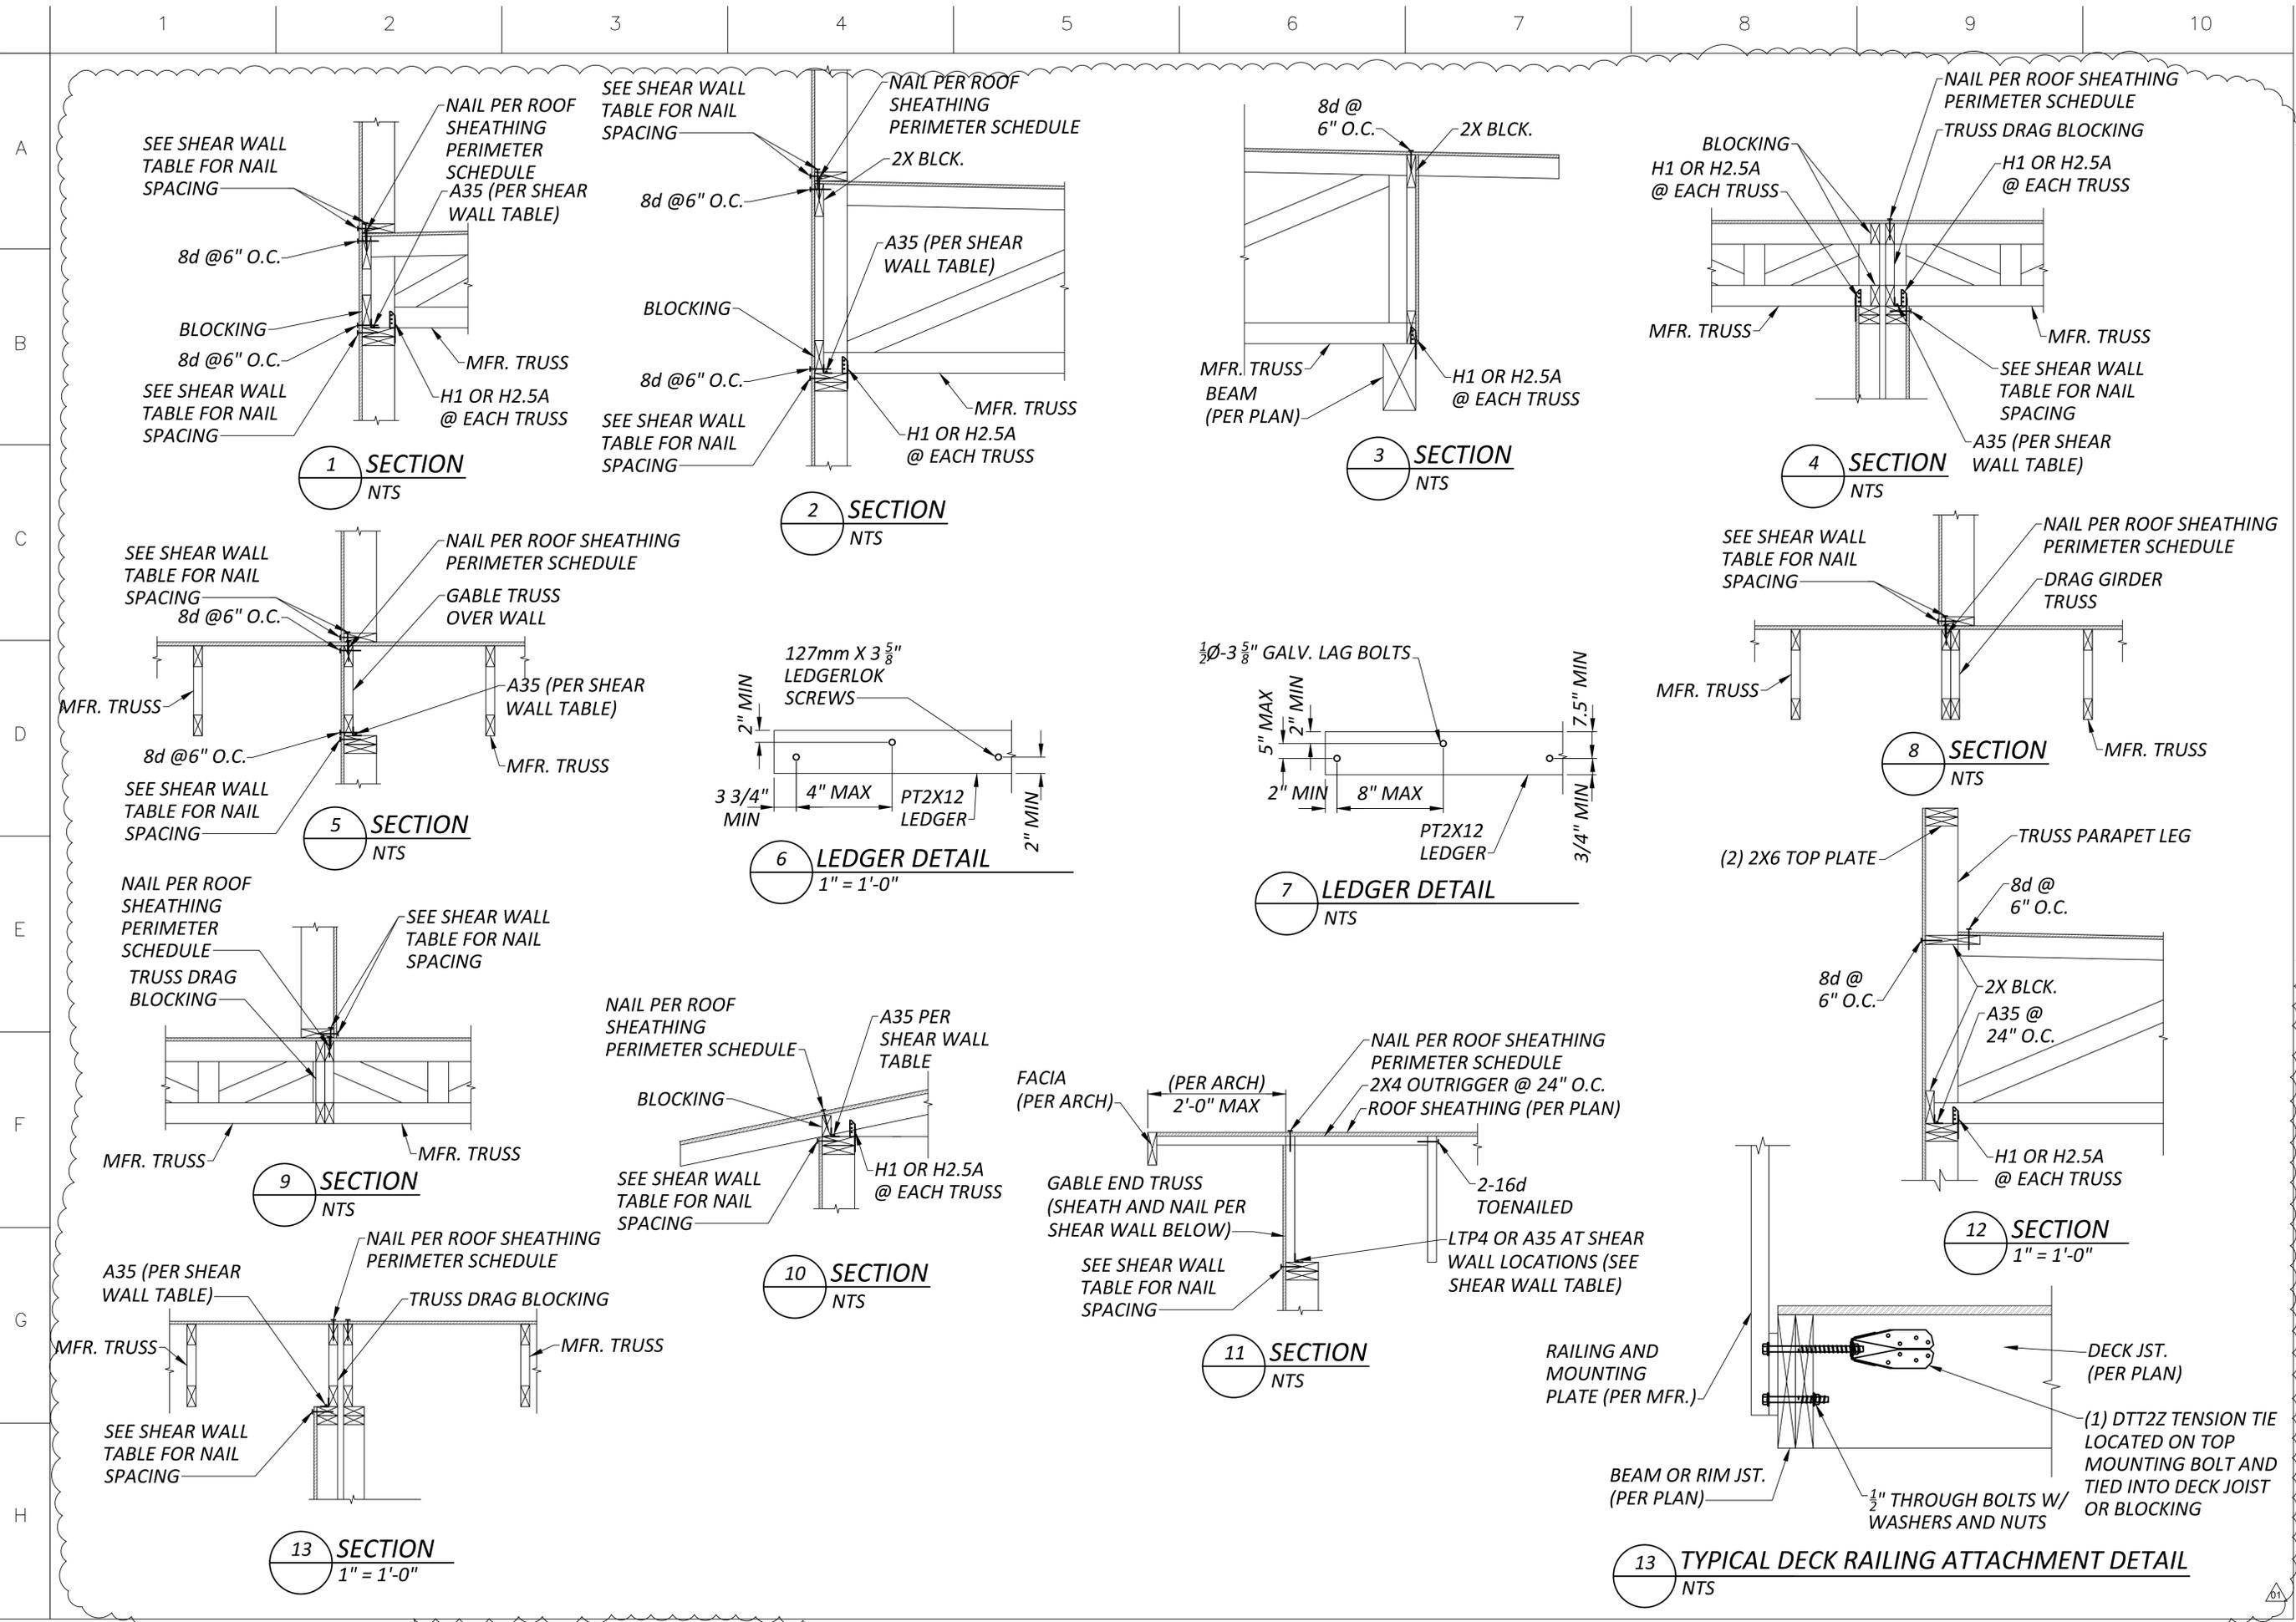

PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
3728 N. BENNETT ST. TACOMA, WA 98407
PIERUCCIONIENGINEERING.COM
206.940.7896

PRGA20250487


City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building Planning
Engineering Public Works
Fire Traffic

EAST TOWN CROSSING
BUILDING 'A'
PIONEER & SHAW PUYALLUP, WA

REVISIONS	
01	REVIEW 1 2024.08.05
REVISIONS	
DRAWN BY:	CP
CHECKED BY:	CP
DATE:	2023.03.05
TITLE:	DETAILS
PROJECT #:	---
SHEET:	

S4.3

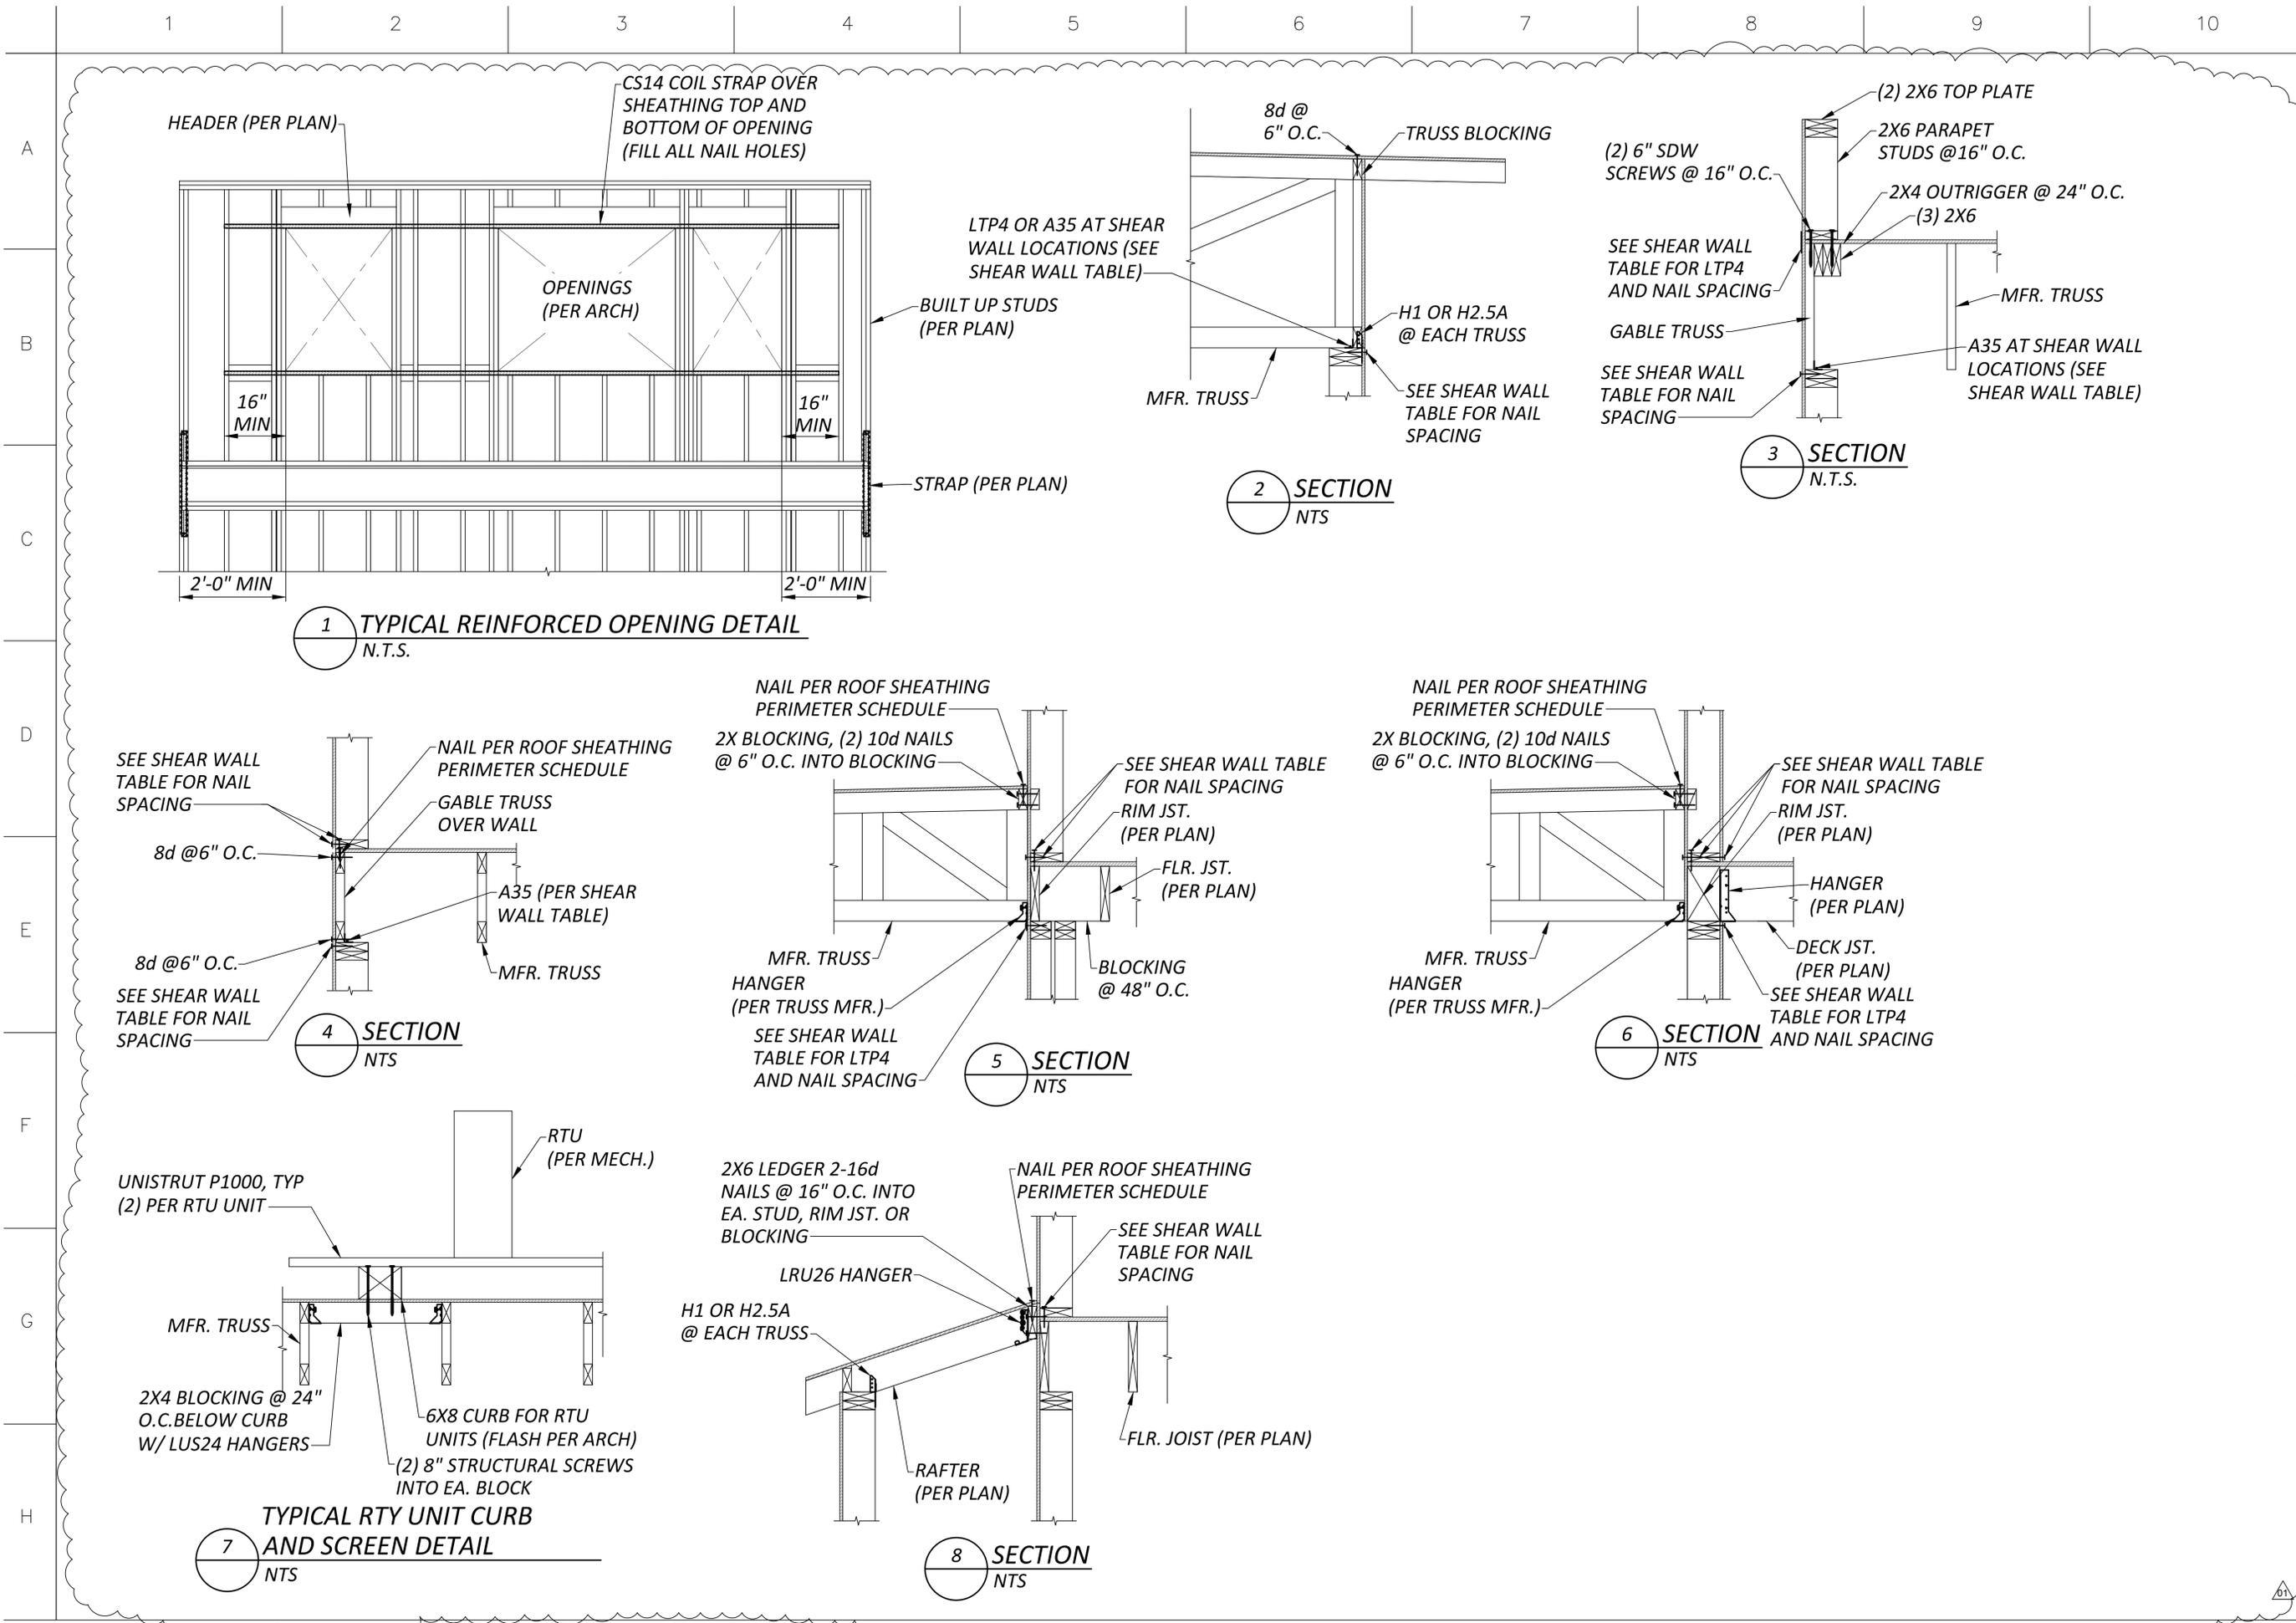

PIERUCCIONI E&C, LLC
CHON PIERUCCIONI, PE
3101 N. BENNETT ST. TACOMA, WA 98407
PIERUCCIONIENGINEERING.COM
206.949.7866

PRGA20250487

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building Planning
Engineering Public Works
Fire Traffic

EAST TOWN CROSSING
BUILDING 'A'
PIONEER & SHAW PUYALLUP WA

REVISIONS	
01	REVIEW 1 2024.08.05

REVISIONS

DRAWN BY: CP
CHECKED BY: CP
DATE: 2023.03.05
TITLE: DETAILS
PROJECT #: ---
SHEET:

S4.4

GENERAL NOTES

GENERAL NOTES – MECHANICAL

- REFERENCE TO RELATED WORK: "REF" INDICATIONS DENOTE WORK COVERED ELSEWHERE (ARCHITECTURAL, STRUCTURAL, CIVIL, ELECTRICAL, LANDSCAPE, OR KITCHEN), OR ITEM BASED ON A SPECIFIC MANUFACTURER'S DIMENSIONS (VERIFY).
- ELECTRICAL CHARACTERISTICS: REFER TO ELECTRICAL DRAWINGS FOR ELECTRICAL CHARACTERISTICS (VOLTAGES, ETC. OF MECHANICAL EQUIPMENT, UNLESS OTHERWISE INDICATED).
- CODES: COMPLETE INSTALLATION OF THE MECHANICAL SYSTEM SHALL BE PER THE APPLICABLE BUILDING, MECHANICAL, ENERGY, PLUMBING, FIRE, AND HEALTH CODES AND REGULATIONS AS ADOPTED BY THE LOCAL AHJ.
- PREPARE AND SUBMIT FOR REVIEW A SHOP DRAWING BASED ON FINAL STRUCTURAL SHOP DRAWINGS FOR LOCATING AND ROUTING ALL DUCTWORK, DAMPERS, EQUIPMENT, PIPING, ETC.
 - COORDINATE FLOOR AND BEAM PENETRATIONS WITH STRUCTURAL.
 - COORDINATE FINAL LOCATION AND ROUTING WITH CEILING, LIGHTS, WALLS, FIRE SPRINKLER PIPING, AND OTHER TRADES WORK.
 - INCLUDE ADDITIONAL OFFSETS, ELBOWS, ROUTING, EQUIVALENT DUCT SIZING EXCHANGE, RELOCATING, ETC. AS REQUIRED FOR A COMPLETE OPERATING MECHANICAL SYSTEM.
 - PROVIDE SHOP DRAWINGS AT NO ADDITIONAL COST TO THE OWNER.
- MECHANICAL CONTRACTOR SHALL LOCATE AND COORDINATE EXACT LOCATION OF ALL MECHANICAL EQUIPMENT WITHIN THE STRUCTURE.
- ACCESS DOORS: COORDINATE WITH ARCHITECT AND LOCATE ALL ACCESS DOORS ON SHOP DRAWINGS PRIOR TO BEGINNING OF CONSTRUCTION. ACCESS DOORS IN FIRE RATED STRUCTURE SHALL BE FIRE RATED. VERIFY ACCESS DOOR LOCATIONS WITH GENERAL CONTRACTOR PRIOR TO BIDDING.
- RATED PENETRATION: DUCT PENETRATIONS THROUGH RATED ENCLOSURES SHALL BE FIRE/SMOKE DAMPERED PER THE LATEST EDITION OF THE UNDERWRITERS LABORATORIES(UL) FIRE RESISTANCE WITH HOURLY RATINGS FOR THROUGH-PENETRATION FIRE STOPS SYSTEM VOLUME #2, OR SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S UL LISTINGS (3M OR EQUIVALENT). DETERMINE REQUIREMENTS WITH GENERAL CONTRACTOR PRIOR TO BID.
- EXHAUST OUTLETS: SOURCE-SPECIFIC FANS SHALL BE VENTED TO OUTDOORS WITH A MINIMUM 3' CLEARANCE BETWEEN VENT OUTLETS AND BUILDING OPENINGS, AND 10' MINIMUM BETWEEN VENT OUTLETS AND MECHANICAL AIR INTAKES.
- ROOF PENETRATIONS: SEE ARCHITECTURAL DRAWINGS FOR ROOF CAP, ROOF CURB, ROOF DRAIN, AND VTR DETAILS.
- EXPOSED PIPING: PROVIDE CHROME PLATING FOR EXPOSED PIPING IN FINISHED ROOMS.
- PENETRATIONS: PROVIDE ESCUTCHEON PLATES FOR EXPOSED PIPING PENETRATIONS AND SHEET METAL FLASHING FOR EXPOSED DUCTWORK PENETRATIONS.
- SHAFT AND PLENUM CONNECTIONS: SEAL CONNECTIONS TO AIR SHAFTS AIRTIGHT. PROVIDE AIRTIGHT SEAL AROUND PENETRATIONS IN AIR PLENUMS.
- LIGHT FIXTURE CLEARANCE: COORDINATE LOCATIONS OF MECHANICAL WORK TO PROVIDE CLEARANCES OVER LIGHTING FIXTURES FOR REMOVAL AND REPLACEMENT.
- MOTORS: COMPLY WITH ENERGY CODE ENFORCED BY AHJ FOR MINIMUM EFFICIENCIES UNDER FULL LOAD.
- ACCESS CLEARANCES FOR MAINTENANCE AND REPLACEMENT: VERIFY PHYSICAL DIMENSIONS OF EQUIPMENT TO ENSURE THAT ACCESS CLEARANCES CAN BE MET. COORDINATE LOCATIONS OF MECHANICAL WORK AND WORK OF OTHER TRADES TO PROVIDE ACCESS CLEARANCES FOR SERVICE AND MAINTENANCE.

COORDINATION REQUIREMENTS

- PIPING: COORDINATE WITH STRUCTURAL FOR EXACT LOCATION OF ALL STRUCTURAL FRAMING AND FOOTINGS AND FINALIZE THE EXACT ROUTING OF ALL PIPES WITH STRUCTURAL AND AT THE SITE PRIOR AND DURING THE CONSTRUCTION.
- DUCTWORK: LOCATE AND COORDINATE THE EXACT LOCATION OF DUCTWORK WITH STRUCTURAL PLANS AND WITH THE GENERAL CONTRACTOR PRIOR TO INSTALLATION OF ANY STRUCTURE OR EQUIPMENT. COORDINATE WITH FRAMING CONTRACTOR TO ASSURE JOIST SPACES LINE UP WHEN DUCTWORK MUST PASS THROUGH DIFFERENT JOIST SPACES.
- ADJUSTMENTS: ALL EQUIPMENT, MOTORS, FANS GAS BURNERS, IGNITION DEVICES, DRIVES, ETC. SHALL BE ADJUSTED AND BALANCED TO OPERATE AT SPECIFIED RATINGS AS REQUIRED FOR THIS PROJECT SITE AND ACCOUNTING FOR ELEVATION ABOVE SEA LEVEL.
- APPROVALS: MECHANICAL AND PLUMBING EQUIPMENT SHALL BE APPROVED FOR INSTALLATION IN THE PROJECT LOCATION AND SHALL HAVE ALL CERTIFICATIONS AND RATINGS TO MEET ALL ENERGY, POLLUTION, ENVIRONMENTAL, SEISMIC, ETC. CODES AND REGULATIONS. THE CONTRACTOR SHALL COORDINATE WITH HIS MANUFACTURE SUPPLIERS AND SHALL INCLUDE ALL COSTS REQUIRED TO MEET THESE REQUIREMENTS IN HIS BID.
- FIRE PROTECTION: CONTRACTOR SHALL PROVIDE A FULLY DESIGNED FIRE PROTECTION SPRINKLER SYSTEM IN COMPLIANCE WITH NFPA AND LOCAL CODES. PROVIDE DESIGN, PERMITS, MATERIALS, INSTALLATION, TESTING AND ALL OTHER FOR A FULLY OPERATIONAL SYSTEM. LOCATION OF ALL PIPING TO BE COORDINATED WITH OTHER TRADES.

PIPING NOTES

- DISASSEMBLY PROVISIONS: PROVIDE UNIONS OR FLANGES AT PIPING CONNECTIONS TO EQUIPMENT, COILS, TRAPS, CONTROL VALVES, AND OTHER COMPONENTS TO ALLOW DISASSEMBLY FOR MAINTENANCE.
- REDUCERS: PROVIDE AS REQUIRED FROM LINE PIPE SIZE TO EQUIPMENT, TRAP, COIL, AND CONTROL VALVE CONNECTION SIZES.
- OFFSETS: PROVIDE FOR BRANCH LINES TO EQUIPMENT.
- DISSIMILAR UNIONS: PROVIDE AT CONNECTIONS OF DISSIMILAR PIPE.
- REFRIGERANT PIPING: PROVIDE SIZING & INSTALLATION IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
- CONDENSATE DRAIN: PROVIDE A P-TRAP FOR EACH HVAC UNIT CONDENSATE PAN WITH PLUG TEES FOR CLEANING. CONDENSATE DRAINS SHALL BE DISCHARGED TO AN INDIRECT WASTE OR OUTSIDE.

INSULATION/LINING NOTES

- ENERGY CODE: AS A MINIMUM, COMPLY WITH THICKNESSES AND TYPES LISTED IN ENERGY CODE ENFORCED BY AHJ.
- EXTENT OF INTERNAL DUCT LINING:
 - GRILLE AND DIFFUSER BOXES AND BOOTS.
 - TRANSFER DUCTS.
 - THE FIRST 10 FEET OF SUPPLY AND RETURN DUCTWORK FROM THE AIR HANDLER.
- EXTENT OF EXTERNAL DUCT INSULATION:
 - SUPPLY AND RETURN AIR IN UNCONDITIONED SPACES, MECHANICAL ROOMS, ELECTRICAL ROOMS, AND EQUIPMENT ROOMS NOT SPECIFIED TO BE INTERNALLY LINED.
 - SUPPLY AIR ABOVE CEILINGS OR EXPOSED NOT SPECIFIED TO BE INTERNALLY LINED.
 - OUTDOOR AIR INTAKE.
- MISCELLANEOUS DUCT FITTINGS (CONICAL TAKEOFFS, ETC.): WRAP WITH INSULATION FOR CONDENSATION CONTROL.

PLAN NOTES

- DUCTWORK SHALL BE METALLIC DUCTWORK
- TEST AND BALANCE WORK SHALL BE PERFORMED BY AN INDEPENDENT TEST AND BALANCE AGENCY. PROVIDE (3) COPIES OF TEST AND BALANCE REPORT TO OWNER.
- COORDINATE DUCTWORK WITH MISCELLANEOUS OBSTRUCTIONS IN CEILING SPACE.
- RESTROOM EXHAUST SHALL BE A MINIMUM OF 10' FROM ANY MECHANICAL OUTSIDE AIR INTAKES.
- ROUTE DUCTWORK UNDERNEATH JOISTS UON.
- TRANSITION DUCT UNDER BEAMS AND DUCTS. FIELD VERIFY AVAILABLE CEILING CAVITY DIMENSIONS.
- COORDINATE MOUNTING HEIGHT OF DIFFUSERS WITH ARCHITECTURAL PLANS.

SHEET METAL NOTES

- REFERENCE: SMACNA HVAC DUCT CONSTRUCTION STANDARDS, METAL AND FLEXIBLE, CURRENT EDITION.
- CLEARANCE: COORDINATE DUCTWORK WITH MISCELLANEOUS OBSTRUCTIONS IN CEILING SPACE.
- ROUND ELBOWS AND OFFSETS: FULL RADIUS (R/D = 1.5), 5-PIECE SEGMENTED OR STAMPED. REFER TO SMACNA HVAC FIG 2-7, 3-3. DO NOT USE ANGLED OFFSET (TYPE 1). MITERED OFFSET (TYPE 2) MAY BE USED UP TO 30 DEGREE OFFSET ANGLE.
- ROUND TEES AND LATERALS: CONICAL TEE PER SMACNA HVAC FIG 3-5; DO NOT USE STRAIGHT TEE. DO NOT USE CONICAL SADDLE TAP FOR EXPOSED DUCTWORK IN FINISHED SPACES. 90-DEGREE TEE WITH OVAL TO ROUND TAP, LATERAL, AND 45-DEGREE RECTANGULAR LEAD-IN PER SMACNA HVAC FIG 3-4.
- RECTANGULAR ELBOWS AND OFFSETS: FULL RADIUS WHERE SPACE PERMITS, R/W = 1.5; OTHERWISE USE SQUARE CORNER ELBOW WITH TURNING VANES.
- RECTANGULAR DIVIDED FLOW FITTINGS: USE GENERALLY, EXCEPT BRANCHES TO TERMINALS; SMACNA HVAC FIG 2-5, TYPES 1, 2, 4A, AND 4B. DO NOT USE TYPE 3.
- TURNING VANES: H.E.P. MANUFACTURER OR APPROVED HIGH EFFICIENCY PROFILE AIRFOIL TYPE FOR RECTANGULAR SQUARE THROAT ELBOWS. ACOUSTICAL TYPE FOR RETURN AIR MITERED ELBOWS.
- TAKEOFFS TO OPENINGS: CONICAL TYPE WITH VOLUME DAMPER FOR ROUND DUCT BRANCHES PER SMACNA HVAC FIG 2-6, MINIMUM INLET DIAMETER 2 INCHES LARGER THAN DUCT SIZE. 45 DEGREE ENTRY FITTING FOR RECTANGULAR DUCT BRANCHES PER SMACNA HVAC FIG 2-6.
- FLEXIBLE CONNECTIONS: PROVIDE AT EACH DUCT CONNECTION TO FANS, PACKAGED HVAC EQUIPMENT, EXTERNALLY ISOLATED AIR HANDLING UNITS, FAN COIL UNITS, AND SIMILAR EQUIPMENT. EXCEPTION: EQUIPMENT IN CORRIDOR CEILING SPACES WHERE FIRE RATING IS REQUIRED.
- ALL DUCT WORK SHALL BE CLASSIFIED FOR LOW PRESSURE SYSTEMS PER IMC SECTION 603.
- ALL DUCTS AND JOINTS SHALL BE SEALED PER IMC SECTION 603.

HVAC NOTES

- ATTACHMENTS: AIR DISTRIBUTION OUTLETS AND LOUVERS

- SHALL HAVE ALL REQUIRED ACCESSORIES AND ATTACHMENTS FOR A COMPLETE CONNECTION TO THE SPECIFIC TYPE OF STRUCTURE THAT THEY ARE BEING ATTACHED TO. THIS INCLUDES, BUT IS NOT LIMITED TO, EXTERIOR BRICKS, GWB WALLS, GWB CEILING, ETC.
- DUCTWORK: DUCTWORK SHALL BE SMOOTH SHEET METAL (CLASS-1). DUCTWORK THROUGH FIRE RATED STRUCTURE AND FLOOR SHALL BE MIN. 26 GA. STEEL. MAXIMUM LENGTH OF FLEXIBLE DUCTS SHALL BE 5'-0", UNLESS OTHERWISE NOTED ON DRAWINGS. DUCTWORK SIZES SHOWN ARE INSIDE CLEAR DIMENSIONS.
- SEISMIC: PROVIDE SEISMIC RESTRAINTS FOR MECHANICAL EQUIPMENT, PIPING, AND DUCTWORK PER SMACNA AND LOCAL REGULATIONS.
- FILTER CLEARANCE: PROVIDE ADEQUATE CLEARANCE FOR CHANGING AIR FILTERS.
- DUCTWORK AND PIPING OUTSIDE OF MECHANICAL ROOMS SHALL BE CONCEALED, COORDINATE WITH THE GENERAL CONTRACTOR TO FUR-OUT AS REQUIRED.
- FIRE RATINGS: RATED FLOOR/CEILING JOINT SPACES HAVING DUCTWORK INSIDE THEM SHALL BE FIRE/SMOKE PROTECTED TO MAINTAIN THE 1-HOUR FLOOR/CEILING RATING PER LOCAL JURISDICTIONS. EXHAUST DUCTWORK PENETRATING THE 1-HOUR ROOF/CEILING OR FLOOR/CEILING ASSEMBLY SHALL HAVE ACCESSIBLE CEILING FIRE DAMPERS. ALTERNATIVELY, THE EXHAUST DUCTWORK SHALL BE ROUTED INSIDE A RATED SHAFT TO PROTECT THE CEILING/ROOF RATING PER THE LOCAL JURISDICTIONS.
- FIRESTOP: PIPE, DUCT AND CONDUIT PENETRATIONS THROUGH RATED ASSEMBLIES SHALL BE FIRE AND SMOKE STOPPED PER CODE.
- DUCTWORK: DUCTWORK SHALL BE SMOOTH SHEET METAL (CLASS-1). DUCTWORK THROUGH FIRE RATED STRUCTURE AND FLOOR SHALL BE MIN. 26 GA. STEEL. MAXIMUM LENGTH OF FLEXIBLE DUCTS SHALL BE 5'-0" UNLESS OTHERWISE NOTED ON DRAWINGS. DUCTWORK SIZES SHOWN ARE INSIDE CLEAR DIMENSIONS.
- VOLUME DAMPERS: PROVIDE AN ACCESSIBLE MANUAL VOLUME DAMPER FOR EACH SUPPLY, RETURN, OSA AND EXHAUST OPENING, LOCATED AS FAR UPSTREAM AS POSSIBLE FROM THE OPENING. PROVIDE A MANUAL VOLUME DAMPER FOR BRANCH MAINS SERVING MORE THAN ONE OPENING. VOLUME DAMPERS IN NON-ACCESSIBLE CEILING SHALL HAVE A CONTROL ARM EXTENDED TO AN ACCESSIBLE LOCATION. PROVIDE "YOUNG" REGULATOR OR EQUAL. EXACT LOCATION OF CONTROL DEVICES VISIBLE IN FINISHED SPACES SHALL BE COORDINATED WITH THE ARCHITECT.
- CORRIDOR THERMOSTAT: PROVIDE TAMPERPROOF THERMOSTATS IN CORRIDORS. DO NOT PROVIDE PLASTIC GUARDS TO MAKE THE THERMOSTATS TAMPERPROOF. PROVIDE BLANK SECURABLE THERMOSTAT COVERS.

APPLICABLE CODE

BUILDING CODE:

2018 WASHINGTON STATE ENERGY CODE-RESIDENTIAL BY WASHINGTON ADMINISTRATIVE CODE CHAP 51-50 (WSEC)

2018 INTERNATIONAL RESIDENTIAL CODE WITH ADMINISTRATIVE CODE CHAP 51-51 (WSRC)

2018 INTERNATIONAL MECHANICAL CODE WITH ADMINISTRATIVE CODE CHAP 51-52 (WSMC)

DRAWINGS ARE DIAGRAMMATIC, SHOWING THE GENERAL LOCATION, TYPE, LAYOUT, AND EQUIPMENT REQUIRED. THE DRAWINGS SHALL NOT BE SCALED FOR EXACT MEASUREMENT. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS. REFER TO MANUFACTURER'S STANDARD INSTALLATION DRAWINGS FOR EQUIPMENT CONNECTIONS AND INSTALLATION REQUIREMENTS. PROVIDE DUCTWORK, CONNECTIONS, ACCESSORIES, OFFSETS, AND MATERIALS NECESSARY FOR A COMPLETE SYSTEM.

PRE-CON MEETING NOTES

CONTRACTORS SHALL ATTEND A PRE-CONSTRUCTION MEETING WITH THE ENGINEER FOR THE PURPOSE OF REVIEWING THE WORK PRIOR TO ORDERING ANY EQUIPMENT OR PERFORMING ANY WORK. THE MEETING SHALL BE LOCATED AT THE PROJECT SITE ON A DATE AND TIME TO BE MUTUALLY AGREED. THE MEETING WILL BE A WORKING SESSION. THE MEETING WILL BE FACILITATED BY THE ENGINEER AND THE AGENDA WILL INCLUDE A DETAILED REVIEW OF THE PLANS AND SPECIFICATIONS, CROSS CHECK WITH OTHER TRADES FOR COORDINATION ISSUES, REVIEW OF PROPOSED PRODUCTS, REVIEW OF PLANNED MEANS AND METHODS, AND ON-SITE INVESTIGATION OF FIELD CONDITIONS RELATIVE TO EXISTING CONDITIONS THAT COULD AFFECT THE WORK. PERSONS ATTENDING THE MEETING SHALL BE KNOWLEDGEABLE OF THE PROJECT AND SHALL BE THE SPECIFIC PERSONS INTENDED TO CONTINUE WITH THE PROJECT THROUGH TO COMPLETION. IF REQUIRED, REVISED PLANS WILL BE ISSUED THROUGH OFFICIAL CHANNELS. CHANGES IN THE BID PRICE WILL BE DISCUSSED, BUT NO CHANGE ORDERS WILL BE ISSUED UNLESS PROCESSED THROUGH OFFICIAL CHANNELS. IT SHALL BE UNDERSTOOD THAT THE ENGINEER HAS NO AUTHORITY TO ISSUE CHANGE ORDERS.

THE FOLLOWING TRADES SHALL BE REPRESENTED FOR THE MINIMUM TIME INDICATED:

MECHANICAL SHEET METAL	4 HOURS
PLUMBING/PIPING	4 HOURS
ELECTRICAL	4 HOURS
SPRINKLER	2 HOURS
GENERAL CONTRACTOR	ALL SESSIONS

ANNOTATIONS

- ACU AIR CONDITIONING UNIT
- AFF ABOVE FINISHED FLOOR
- AHJ AUTHORITY HAVING JURISDICTION
- AHU AIR HANDLING UNIT
- BDD BACKDRAFT DAMPER
- BHP BRAKE HORSEPOWER
- BTUH BRITISH THERMAL UNIT PER HOUR
- C COMMON
- CAP CAPACITY
- CC COOLING COIL
- CD CEILING DIFFUSER
- CFM CUBIC FEET PER MINUTE
- CLG CEILING, COOLING
- CO CLEANOUT
- COMB COMBUSTION
- CONT CONTINUE, CONTROL
- CONTR CONTRACTOR
- COP COEFFICIENT OF PERFORMANCE
- CWS CHILLED WATER SUPPLY
- CWR CHILLED WATER RETURN
- D DIAMETER
- DB DRY BULB, DECIBEL
- DEG DEGREE
- DNM DIMENSION
- DISCH DISCHARGE
- DN DOWN
- EA EXHAUST AIR
- EAT ENTERING AIR TEMPERATURE
- EER ENERGY EFFICIENCY RATIO
- EF EXHAUST FAN
- EFF EFFICIENCY
- EG EXHAUST GRILLE, ENGINE GENERATOR
- ELEC ELECTRIC
- EQUIV EQUIVALENT
- ESP EXTERNAL STATIC PRESSURE
- EXH EXHAUST
- EXT EXTERIOR, EXTERNAL
- F FAHRENHEIT
- FU FIRE DAMPER
- FCU FAN COIL UNIT
- FLR FLOOR
- FPM FEET PER MINUTE
- FPS FEET PER SECOND
- FSD FIRE/SMOKE DAMPER
- G GAS
- GRD GRILLES, REGISTERS, AND DIFFUSERS
- GWB GYPSUM WALLBOARD
- HORIZ HORIZONTAL
- HP HORSEPOWER, HEAT PUMP
- HU HEAT RECOVERY UNIT
- HVAC HEATING, VENTILATING, AND AIR CONDITIONING
- HVU HEATING AND VENTILATION UNIT
- HWR HIGH WALL RETURN, HOT WATER RETURN
- HWS HIGH WALL SUPPLY, HOT WATER SUPPLY
- HX HEAT EXCHANGER
- ID INDIRECT DRAIN, INSIDE DIAMETER
- IN INCH
- KW KILOWATT
- L LONG, LENGTH
- LB POUND
- LWR LOW WALL RETURN
- LWS LOW WALL SUPPLY
- MBH THOUSAND BTU PER HOUR
- MECH MECHANICAL
- MCA MINIMUM CIRCUIT AMPACITY
- MOCP MAXIMUM OVER CURRENT PROTECTION
- MTD MOUNTED
- OSA OUTDOOR AIR
- OBD OPPOSED BLADE DAMPER
- OD OUTSIDE DIMENSION OR DIAMETER
- OPNG OPENING
- P PUMP
- PD PRESSURE DROP
- POC POINT OF CONNECTION
- PRV PRESSURE REDUCING VALVE
- PSIG POUNDS PER SQUARE INCH GAUGE
- RA RETURN AIR
- REF REFERENCE
- RF RELIEF FAN
- RG RETURN GRILLE
- RPM REVOLUTIONS PER MINUTE
- SA SUPPLY AIR
- SCH SCHEDULE
- SF SUPPLY FAN, SQUARE FOOT
- SENS SENSIBLE
- SG SUPPLY GRILLE
- SMACNA SHEET METAL AND AIR CONDITIONING CONTRACTORS NATIONAL ASSOCIATION
- SO SCREENED OPENING
- SP STATIC PRESSURE
- SS STAINLESS STEEL, SANITARY
- SQ SQUARE
- TG TRANSFER GRILLE
- TYP TYPICAL
- UH UNIT HEATER
- UON UNLESS OTHERWISE NOTED
- V VENT
- VENT VENTILATION, VENTILATOR
- VTR VENT THRU ROOF
- W WASTE, WATT, WIDE
- WB WET BULB (TEMPERATURE)

SYMBOLS

DUCTWORK

DUCT (1ST FIGURE = SIDE SHOWN, 2ND FIGURE = SIDE NOT SHOWN)

DUCT SECTION, POSITIVE PRESSURE

DUCT SECTION, NEGATIVE PRESSURE

ROUND DUCT SECTION

DUCT PENETRATION THRU FLOOR OR ROOF

VOLUME DAMPER

FIRE/SMOKE DAMPER (--- = HORIZ DUCT, --- = VERT DUCT), 2-HR RATED, UON

FIRE DAMPER (--- = HORIZ DUCT, --- = VERT DUCT), 2-HR RATED, UON

90° ELBOW, R/D OR R/W=1.5

SQUARE CORNER ELBOW WITH TURNING VANES

90° TAKE-OFF OR TEE

90° CONICAL TAKE-OFF

45° LATERAL TAKE-OFF

TRANSITION OR REDUCER (FOT = FLAT ON TOP, FOB = FLAT ON BOTTOM)

WYE FITTING

90° RECTANGULAR TAKE-OFF WITH 45° TAPER

90° DIVERGING RECTANGULAR TEE, EITHER RADIUS OR TURNING VANES

PARALLEL FLOW BRANCH CONNECTION, EITHER RADIUS OR TURNING VANES

FLEXIBLE DUCT

ROUND DUCT INDICATOR

EQUIPMENT

TYPICAL EQUIPMENT DESIGNATION (EXHAUST FAN SHOWN)

DUCT SMOKE DETECTOR

ROOM THERMOSTAT OR TEMPERATURE TRANSMITTER

ROOM HUMIDISTAT OR HUMIDITY TRANSMITTER

CARBON MONOXIDE SENSOR

SMOKE DETECTOR

TERMINALS

DIFFUSER/GRILLE TYPE, AND NUMBER OR SIZE

DESIGN CFM (WHERE APPLICABLE) CEILING DIFFUSER (FLOW ARROWS SHOWN FOR NON SYMMETRICAL AIRFLOW)

CEILING RETURN/EXHAUST GRILLE

LINEAR DIFFUSER, CEILING OR WALL MOUNTED (FLOW ARROWS SHOWN FOR NON SYMMETRICAL AIRFLOW)

WALL SUPPLY GRILLE (SG)

WALL RETURN/EXHAUST GRILLE (RG, EG)

TRANSFER GRILLE (TG), DUCT CONNECTED, WALL MOUNTED W/ OPTIONAL CFM SHOWN

TRANSFER GRILLE, CEILING MOUNTED WITH FULL-SIZED LINED DUCT CONNECTION



City of Puyallup
Development & Permitting Services
ISSUED PERMIT


Building	Planning
Engineering	Public Works
Fire	Traffic

DRAWING INDEX

Sheet List Table

Sheet Number	Sheet Title	PERMIT SET 7/29/2025	PERMIT RESUBMITTAL #2 SET 8/29/2025
M0.0	LEGEND, GENERAL NOTES, & DRAWING INDEX	X	X
M0.1	PROJECT NOTES	X	X
M0.2	TABLES & CALCULATIONS	X	X
M0.3	MECHANICAL SCHEDULES	X	X
M0.4	WSEC FORMS	X	X
M1.0	SITE PLAN	X	X
M2.0	HVAC PLAN - LEVEL 1	X	X
M2.1	HVAC PLAN - LEVEL 2	X	X
M2.3	HVAC PLAN - LEVEL 3 & ROOF	X	X
M3.0	HVAC ENLARGED PLANS	X	X
M4.0	DETAILS & DIAGRAMS	X	X
M4.1	DETAILS & DIAGRAMS	X	X

NO.	DATE	DESCRIPTION
1	8/29/25	PERMIT RESUBMITTAL #2



DRAWN: ABE	DESIGNED: ABE	CHECKED: PR	APPROVED: JMR
------------	---------------	-------------	---------------

PROJECT: EAST TOWN CROSSING BUILDING A
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 864-3343
RE PROJECT NO.: 810010
CONTACT: ARK.ESPINELLI

ROBISON ENGINEERING, INC.

DATE: 08/29/2025

SHEET TITLE:
LEGEND, GENERAL NOTES, & DRAWING INDEX

SHEET NO.
M0.0

ENERGY CODE NOTES

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building Planning
Engineering Public Works
Fire Traffic

PRGA20250487

WASHINGTON STATE COMMISSIONING REQUIREMENTS

C408.1.1 CONSTRUCTION DOCUMENTS SHALL CLEARLY INDICATE PROVISIONS FOR COMMISSIONING PROCESS. THE CONSTRUCTION DOCUMENTS SHALL MINIMALLY INCLUDE THE FOLLOWING:

1. A NARRATIVE DESCRIPTION OF THE ACTIVITIES THAT WILL BE ACCOMPLISHED DURING THE COMMISSIONING PROCESS. AT A MINIMUM, THE COMMISSIONING PROCESS IS REQUIRED TO INCLUDE:
 - 1.1. DEVELOPMENT AND EXECUTION OF THE COMMISSIONING PLAN, INCLUDING ALL SUBSECTIONS OF SECTION C408.1.2;
 - 1.2. THE CERTIFIED COMMISSIONING PROFESSIONAL'S REVIEW OF THE BUILDING DOCUMENTATION AND CLOSE OUT SUBMITTALS IN ACCORDANCE WITH SECTION C103.6; AND
 - 1.3. THE COMMISSIONING REPORT IN ACCORDANCE WITH SECTION C408.1.3.
2. ROLES, RESPONSIBILITIES AND REQUIRED QUALIFICATIONS OF THE CERTIFIED COMMISSIONING PROFESSIONAL.
3. A LISTING OF THE SPECIFIC EQUIPMENT, APPLIANCES OR SYSTEMS TO BE TESTED.

C408.1.2 A COMMISSIONING PLAN SHALL BE DEVELOPED BY THE PROJECT'S CERTIFIED COMMISSIONING PROFESSIONAL AND SHALL OUTLINE THE ORGANIZATION, SCHEDULE, ALLOCATION OF RESOURCES, AND DOCUMENTATION REQUIREMENTS OF THE COMMISSIONING PROCESS. THE PLAN SHALL ALSO INCLUDE THE FOLLOWING:

1. A NARRATIVE DESCRIPTION OF THE ACTIVITIES THAT WILL BE ACCOMPLISHED DURING EACH PHASE OF COMMISSIONING, INCLUDING THE PERSONNEL INTENDED TO ACCOMPLISH EACH OF THE ACTIVITIES, SYSTEMS TESTING AND BALANCING, FUNCTIONAL PERFORMANCE TESTING, AND VERIFICATION OF THE BUILDING DOCUMENTATION REQUIREMENTS IN SECTION C103.6.
2. ROLES AND RESPONSIBILITIES OF THE COMMISSIONING TEAM, INCLUDING THE NAME AND STATEMENT OF QUALIFICATIONS OF THE CERTIFIED COMMISSIONING PROFESSIONAL.
3. A LISTING OF THE SPECIFIC EQUIPMENT, APPLIANCES OR SYSTEMS TO BE TESTED AND A DESCRIPTION OF THE TESTS TO BE PERFORMED.

C408.1.2.1 WHERE THE CERTIFIED COMMISSIONING PROFESSIONAL'S CONTRACT OR EMPLOYMENT IS OTHER THAN DIRECTLY WITH THE BUILDING OWNER, AN IN-HOUSE COMMISSIONING DISCLOSURE AND CONFLICT MANAGEMENT PLAN SHALL BE A PART OF THE COMMISSIONING PROCESS. A COPY SHALL BE INCLUDED IN THE COMMISSIONING PLAN. THIS PLAN SHALL DISCLOSE THE CERTIFIED COMMISSIONING PROFESSIONAL'S CONTRACTUAL RELATIONSHIP WITH OTHER TEAM MEMBERS AND PROVIDE A CONFLICT MANAGEMENT PLAN DEMONSTRATING THAT THE CERTIFIED COMMISSIONING PROFESSIONAL IS FREE TO IDENTIFY ANY ISSUES DISCOVERED AND REPORT DIRECTLY TO THE OWNER.

C408.1.2.2 FUNCTIONAL PERFORMANCE TESTING SHALL BE CONDUCTED FOR MECHANICAL SYSTEMS IN SECTIONS C403; SERVICE WATER HEATING SYSTEMS IN SECTION C404; CONTROLLED RECEPTACLES AND LIGHTING CONTROL SYSTEMS IN SECTION C405; EQUIPMENT, APPLIANCES AND SYSTEMS INSTALLED TO COMPLY WITH SECTION C406 OR C407; ENERGY METERING IN SECTION C409; AND REFRIGERATION SYSTEMS IN SECTION C410. WRITTEN PROCEDURES WHICH CLEARLY DESCRIBE THE INDIVIDUAL SYSTEMATIC TEST PROCEDURES, THE EXPECTED SYSTEM RESPONSE OR ACCEPTANCE CRITERIA FOR EACH PROCEDURE, THE ACTUAL RESPONSE OR FINDINGS, AND ANY PERTINENT DISCUSSION SHALL BE FOLLOWED. THIS TESTING SHALL INCLUDE CONTROL SYSTEMS WHICH WILL BE TESTED TO DOCUMENT THAT CONTROL DEVICES, COMPONENTS, EQUIPMENT, AND SYSTEMS ARE CALIBRATED AND ADJUSTED TO OPERATE IN ACCORDANCE WITH APPROVED CONSTRUCTION DOCUMENTS. TESTING SHALL AFFIRM THE CONDITIONS REQUIRED WITHIN SECTIONS C408.2 THROUGH C408.7 UNDER SYSTEM TESTING.

C408.1.2.3 FOR PROJECTS WITH SEVEN OR FEWER SIMILAR SYSTEMS, EACH SYSTEM SHALL BE TESTED. FOR PROJECTS WITH MORE THAN SEVEN SYSTEMS, TESTING SHALL BE DONE FOR EACH UNIQUE COMBINATION OF CONTROLS TYPE. WHERE MULTIPLES OF EACH UNIQUE COMBINATION OF CONTROL TYPES EXIST, NO FEWER THAN 20 PERCENT OF EACH COMBINATION SHALL BE TESTED UNLESS THE CODE OFFICIAL OR DESIGN PROFESSIONAL REQUIRES A HIGHER PERCENTAGE TO BE TESTED. WHERE 30 PERCENT OR MORE OF THE TESTED SYSTEM FAIL, ALL REMAINING IDENTICAL COMBINATIONS SHALL BE TESTED.

C408.1.2.4 DEFICIENCIES FOUND DURING TESTING SHALL BE RESOLVED INCLUDING CORRECTIONS AND RETESTING.

C408.1.3 A FINAL COMMISSIONING REPORT SHALL BE COMPLETED AND CERTIFIED BY THE CERTIFIED COMMISSIONING PROFESSIONAL AND DELIVERED TO THE BUILDING OWNER OR OWNER'S AUTHORIZED AGENT. THE REPORT SHALL BE ORGANIZED WITH MECHANICAL, SERVICE WATER HEATING, CONTROLLED RECEPTACLE AND LIGHTING CONTROL SYSTEMS, ENERGY METERING, AND REFRIGERATION FINDINGS IN SEPARATE SECTIONS TO ALLOW INDEPENDENT REVIEW. THE REPORT SHALL RECORD THE ACTIVITIES AND RESULTS OF THE COMMISSIONING PROCESS AND BE DEVELOPED FROM THE FINAL COMMISSIONING PLAN WITH ALL OF ITS ATTACHED APPENDICES. THE REPORT SHALL INCLUDE:

1. RESULTS OF FUNCTIONAL PERFORMANCE TESTS.
2. DISPOSITION OF DEFICIENCIES FOUND DURING TESTING, INCLUDING DETAILS OF CORRECTIVE MEASURES USED OR PROPOSED.
3. FUNCTIONAL PERFORMANCE TEST PROCEDURES USED DURING THE COMMISSIONING PROCESS INCLUDING MEASURABLE CRITERIA FOR TEST ACCEPTANCE, PROVIDED HEREIN FOR REPEATABILITY.
4. COMMISSIONING PLAN.
5. TESTING, ADJUSTING AND BALANCING REPORT. EXCEPTION: DEFERRED TESTS WHICH CANNOT BE PERFORMED AT THE TIME OF REPORT PREPARATION DUE TO CLIMATIC CONDITIONS.

C408.1.4 PRIOR TO THE FINAL MECHANICAL, PLUMBING AND ELECTRICAL INSPECTIONS OR OBTAINING A CERTIFICATE OF OCCUPANCY, THE CERTIFIED COMMISSIONING PROFESSIONAL SHALL PROVIDE EVIDENCE OF BUILDING COMMISSIONING IN ACCORDANCE WITH THE PROVISIONS OF THIS SECTION.

C408.1.4.1 BUILDINGS, OR PORTIONS THEREOF, SHALL NOT BE CONSIDERED ACCEPTABLE FOR A FINAL INSPECTION PURSUANT TO SECTION C104.2.6 UNTIL THE CODE OFFICIAL HAS RECEIVED A LETTER OF TRANSMITTAL FROM THE BUILDING OWNER OR OWNER'S REPRESENTATIVE ACKNOWLEDGING THAT THE BUILDING OWNER OR OWNER'S AUTHORIZED AGENT HAS RECEIVED THE COMMISSIONING REPORT. COMPLETION OF COMMISSIONING COMPLIANCE CHECKLIST (FIGURE C408.1.4.1) IS DEEMED TO SATISFY THIS REQUIREMENT. PHASED ACCEPTANCE OF COMMISSIONING COMPLIANCE CHECKLIST FOR PORTIONS OF THE WORK SPECIFIC TO THE TRADE THAT IS BEING INSPECTED IS PERMISSIBLE WHERE ACCEPTED BY THE CODE OFFICIAL AND WHERE THE CERTIFIED COMMISSIONING PROFESSIONAL REMAINS RESPONSIBLE FOR COMPLETION OF THE COMMISSIONING PROCESS. IF THERE ARE UNRESOLVED DEFICIENCIES WHEN THE FINAL INSPECTION IS SCHEDULED, THE COMMISSIONING REPORT SHALL BE SUBMITTED AND SHALL DESCRIBE THE UNRESOLVED DEFICIENCIES.

C408.1.4.2 THE CODE OFFICIAL SHALL BE PERMITTED TO REQUIRE THAT A COPY OF THE COMMISSIONING REPORT BE MADE AVAILABLE FOR REVIEW BY THE CODE OFFICIAL.

C408.2 MECHANICAL EQUIPMENT AND CONTROLS SUBJECT TO SECTION C403 SHALL BE INCLUDED IN THE COMMISSIONING PROCESS REQUIRED BY SECTION C408.1. THE COMMISSIONING PROCESS SHALL MINIMALLY INCLUDE ALL ENERGY CODE REQUIREMENTS FOR WHICH THE CODE STATES THAT EQUIPMENT OR CONTROLS SHALL "BE CAPABLE OF" OR CONFIGURED TO PERFORM SPECIFIC FUNCTIONS. EXCEPTION: MECHANICAL SYSTEMS ARE EXEMPT FROM THE COMMISSIONING PROCESS WHERE THE INSTALLED TOTAL MECHANICAL EQUIPMENT CAPACITY IS LESS THAN 240,000 BTU/H COOLING CAPACITY AND LESS THAN 300,000 BTU/H HEATING CAPACITY.

C408.2.2 HVAC SYSTEMS SHALL BE BALANCED IN ACCORDANCE WITH GENERALLY ACCEPTED ENGINEERING STANDARDS. AIR AND WATER FLOW RATES SHALL BE MEASURED AND ADJUSTED TO DELIVER FINAL FLOW RATES WITHIN THE TOLERANCES PROVIDED IN THE PROJECT SPECIFICATIONS. TEST AND BALANCE ACTIVITIES SHALL INCLUDE AIR SYSTEM AND HYDRONIC SYSTEM BALANCING.

C408.2.2.1 EACH SUPPLY AIR OUTLET AND ZONE TERMINAL DEVICE SHALL BE EQUIPPED WITH MEANS FOR AIR BALANCING IN ACCORDANCE WITH THE REQUIREMENTS OF CHAPTER 6 OF THE INTERNATIONAL MECHANICAL CODE. DISCHARGE DAMPERS USED FOR AIR SYSTEM BALANCING ARE PROHIBITED ON CONSTANT VOLUME FANS AND VARIABLE VOLUME FANS WITH MOTORS 10 HP (18.6 KW) AND LARGER. AIR SYSTEMS SHALL BE BALANCED IN A MANNER TO FIRST

MINIMIZE THROTTLING LOSSES THEN, FOR FANS WITH SYSTEM POWER OF GREATER THAN 1 HP (0.74 KW), FAN SPEED SHALL BE ADJUSTED TO MEET DESIGN FLOW CONDITIONS. EXCEPTION: FANS WITH FAN MOTORS OF 1 HP (0.74 KW) OR LESS.

C408.2.2.2 INDIVIDUAL HYDRONIC HEATING AND COOLING COILS SHALL BE EQUIPPED WITH MEANS FOR BALANCING AND MEASURING FLOW. HYDRONIC SYSTEMS SHALL BE PROPORTIONATELY BALANCED IN A MANNER TO FIRST MINIMIZE THROTTLING LOSSES, THEN THE PUMP IMPELLER SHALL BE TRIMMED OR PUMP SPEED SHALL BE ADJUSTED TO MEET DESIGN FLOW CONDITIONS. EACH HYDRONIC SYSTEM SHALL HAVE EITHER THE CAPABILITY TO MEASURE PRESSURE ACROSS THE PUMP, OR TEST PORTS AT EACH SIDE OF EACH PUMP. EXCEPTION: THE FOLLOWING EQUIPMENT IS NOT REQUIRED TO BE EQUIPPED WITH MEANS FOR BALANCING OR MEASURING FLOW:

1. PUMPS WITH PUMP MOTORS OF 5 HP (3.7 KW) OR LESS.
2. WHERE THROTTLING RESULTS IN NO GREATER THAN FIVE PERCENT OF THE NAMEPLATE HORSEPOWER DRAW ABOVE THAT REQUIRED IF THE IMPELLER WERE TRIMMED.

C408.2.3 FUNCTIONAL PERFORMANCE TESTING SHALL DEMONSTRATE THE COMPONENTS, SYSTEMS, AND SYSTEM-TO-SYSTEM INTERFACING RELATIONSHIPS ARE INSTALLED AND OPERATE IN ACCORDANCE WITH APPROVED CONSTRUCTION DOCUMENTS. TESTING SHALL INCLUDE THE SEQUENCE OF OPERATION, AND BE CONDUCTED UNDER FULL-LOAD, OART-LOAD AND THE FOLLOWING CONDITIONS:

1. ALL MODES AS DESCRIBED IN THE SEQUENCE OF OPERATION;
2. REDUNDANT OR AUTOMATIC BACK-UP MODE;
3. PERFORMANCE OF ALARMS; AND
4. MODE OF OPERATION UPON LOSS OF POWER AND RESTORATION OF POWER.

C408.3 SERVICE WATER HEATING EQUIPMENT AND CONTROLS SUBJECT TO SECTION C404 SHALL BE INCLUDED IN THE COMMISSIONING PROCESS REQUIRED BY SECTION C408.1. THE COMMISSIONING PROCESS SHALL MINIMALLY INCLUDE EQUIPMENT AND COMPONENTS INSTALLED TO MEET ALL ENERGY CODE REQUIREMENTS FOR DEVICES TO "START," "AUTOMATICALLY TURN OFF," "AUTOMATICALLY ADJUST," "LIMIT OPERATION," AND "LIMIT THE TEMPERATURE" AND "BE CONFIGURED TO."

C408.4 CONTROLLED RECEPTACLES AND LIGHTING CONTROL SYSTEMS SUBJECT TO SECTION C405 SHALL BE INCLUDED IN THE COMMISSIONING PROCESS REQUIRED BY SECTION C408.1. THE CONFIGURATION AND FUNCTION OF CONTROLLED RECEPTACLES AND LIGHTING CONTROL SYSTEMS REQUIRED BY THIS CODE SHALL BE TESTED AND SHALL COMPLY WITH SECTION C408.4.1 EXCEPTION: LIGHTING CONTROL SYSTEMS ARE EXEMPT FROM THE COMMISSIONING PROCESS IN BUILDINGS WHERE:

1. THE TOTAL INSTALLED LIGHTING LOAD IS LESS THAN 20 KW, AND
2. THE LIGHTING LOAD CONTROLLED BY OCCUPANCY SENSORS OR AUTOMATIC DAYLIGHTING CONTROLS IS LESS THAN 10 KW.

C408.5 EQUIPMENT, COMPONENTS, CONTROLS OR CONFIGURATION SETTINGS FOR SYSTEMS WHICH ARE INCLUDED IN THE PROJECT TO COMPLY WITH SECTION C406 OR C407 SHALL BE INCLUDED IN THE COMMISSIONING PROCESS REQUIRED BY SECTION C408.1.

C408.6 ENERGY METERING SYSTEMS REQUIRED BY SECTION C409 SHALL COMPLY WITH SECTION C408.6 AND BE INCLUDED IN THE COMMISSIONING PROCESS REQUIRED BY SECTION C408.1. THE COMMISSIONING PROCESS SHALL INCLUDE ALL ENERGY METERING EQUIPMENT AND CONTROLS REQUIRED BY SECTION C409.

C408.7 ALL INSTALLED REFRIGERATION SYSTEMS SUBJECT TO SECTION C410 SHALL BE INCLUDED IN THE COMMISSIONING PROCESS REQUIRED BY SECTION C408.1. EXCEPTIONS:

1. SELF-CONTAINED REFRIGERATION SYSTEMS ARE EXEMPT FROM THE COMMISSIONING PROCESS.
2. TOTAL INSTALLED CAPACITY FOR REFRIGERATION IS EQUAL TO OR LESS THAN 240,000 BTUH.

WASHINGTON STATE CLOSE OUT DOCUMENTATION

C103.6 THE CONSTRUCTION DOCUMENTS SHALL SPECIFY THAT THE DOCUMENTS DESCRIBED IN THIS SECTION BE PROVIDED TO THE BUILDING OWNER OR OWNER'S AUTHORIZED AGENT WITHIN A MAXIMUM 90 DAYS OF THE DATE OF RECEIPT OF THE CERTIFICATION OF OCCUPANCY. (C103.6.1 RECORD DOCUMENTS, C103.6.2 BUILDING OPERATIONS AND MAINTENANCE INFORMATION, C103.6.2.1 MANUALS, C103.6.3 COMPLIANCE DOCUMENTATION, C103.6.4 SYSTEMS OPERATION TRAINING)

WASHINGTON STATE ENERGY CODE

C403.4.1 THE SUPPLY OF HEATING AND COOLING ENERGY TO EACH ZONE SHALL BE CONTROLLED BY INDIVIDUAL THERMOSTATIC CONTROLS CAPABLE OF RESPONDING TO TEMPERATURE WITHIN THE ZONE.

C403.4.1.1 UNITARY AIR COOLED HEAT PUMPS SHALL INCLUDE MICROPROCESSOR CONTROLS THAT MINIMIZE SUPPLEMENTAL HEAT USAGE DURING START-UP, SET-UP, AND DEFROST CONDITIONS. THESE CONTROLS SHALL ANTICIPATE NEED FOR HEAT AND USE COMPRESSION HEATING AS THE FIRST STAGE OF HEAT. CONTROLS SHALL INDICATE WHEN SUPPLEMENTAL HEATING IS BEING USED THROUGH VISUAL MEANS (E.G., LED INDICATORS). HEAT PUMPS EQUIPPED WITH SUPPLEMENTAL HEATERS SHALL BE INSTALLED WITH CONTROLS THAT PREVENT SUPPLEMENTAL HEATER OPERATION ABOVE 40F.

C403.4.1.2 WHERE USED TO CONTROL BOTH HEATING AND COOLING, ZONE THERMOSTATIC CONTROLS SHALL BE CONFIGURED TO PROVIDE A TEMPERATURE RANGE OR DEADBAND OF AT LEAST 5F WITHIN WHICH THE SUPPLY OF HEATING AND COOLING ENERGY TO THE ZONE IS SHUT OFF OR REDUCED TO A MINIMUM.

C403.7.8.1 OUTDOOR AIR SUPPLY, EXHAUST OPENINGS AND RELIEF OUTLETS AND STAIRWAY AND ELEVATOR HOISTWAY SHAFT VENTS SHALL BE PROVIDED WITH CLASS 1 MOTORIZED DAMPERS. SEE SECTIONS C403.10.1 AND C403.10.2 FOR DUCTWORK INSULATION REQUIREMENTS UPSTREAM AND DOWNSTREAM OF THE SHUTOFF DAMPER. EXCEPTION:

1. GRAVITY (NONMOTORIZED) DAMPERS SHALL BE PERMITTED IN LIEU OF MOTORIZED DAMPERS AS FOLLOWS:
 - 1.1. RELIEF DAMPERS SERVING SYSTEMS LESS THAN 5,000 CFM TOTAL SUPPLY SHALL BE PERMITTED IN BUILDINGS LESS THAN THREE STORIES IN HEIGHT.
 - 1.2. GRAVITY (NONMOTORIZED) DAMPERS WHERE THE DESIGN OUTDOOR AIR INTAKE OR EXHAUST CAPACITY DOES NOT EXCEED 400 CFM.
 - 1.3. SYSTEMS SERVING AREAS WHICH REQUIRE CONTINUOUS OPERATION FOR 24/7 OCCUPANCY SCHEDULES.
2. SHUTOFF DAMPERS ARE NOT REQUIRED IN:
 - 2.1. COMBUSTION AIR INTAKES.
 - 2.2. SYSTEMS SERVING AREAS WHICH REQUIRE CONTINUOUS OPERATION IN ANIMAL HOSPITALS, KENNELS AND POUNDS, LABORATORIES, GROUP H, I AND R OCCUPANCIES.
 - 2.3. SUBDUCT EXHAUST SYSTEMS OR OTHER SYSTEMS THAT ARE REQUIRED TO OPERATE CONTINUOUSLY BY THE INTERNATIONAL MECHANICAL CODE.
 - 2.4. TYPE I GREASE EXHAUST SYSTEMS OR OTHER SYSTEMS WHERE DAMPERS ARE PROHIBITED BY THE INTERNATIONAL MECHANICAL CODE TO BE IN THE AIRSTREAM.
 - 2.5. UNCONDITIONED STAIRWELLS OR UNCONDITIONED ELEVATOR HOISTWAY SHAFTS THAT ARE ONLY CONNECTED TO UNCONDITIONED SPACES.

C403.7.8.2 RETURN AIR OPENINGS USED FOR AIRSIDE ECONOMIZER OPERATION SHALL BE EQUIPPED WITH CLASS 1 MOTORIZED DAMPERS.

C403.7.8.3 CLASS 1 DAMPERS SHALL HAVE A MAXIMUM LEAKAGE RATE OF 4 CFM/SF WHEN TESTED IN ACCORDANCE WITH AMCA 500P AND SHALL BE LABELED BY AN APPROVED AGENCY FOR SUCH PURPOSE. GRAVITY (NONMOTORIZED) DAMPERS SHALL HAVE AN AIR LEAKAGE RATE NOT GREATER THAN 20 CFM/SF WHERE NOT LESS THAN 24 INCHES IN EITHER DIMENSION AND 40 CFM/SF WHERE LESS THAN 24 INCHES IN EITHER DIMENSION. THE RATE OF AIR LEAKAGE SHALL BE DETERMINED AT 1.0 INCH W.G. WHEN TESTED IN ACCORDANCE WITH AMCA500P FOR SUCH PURPOSE. THE DAMPERS SHALL BE LABELED BY AN APPROVED AGENCY. GRAVITY DAMPERS FOR VENTILATION AIR INTAKES SHALL BE PROTECTED FROM DIRECT EXPOSURE TO

WIND. EXCEPTIONS:

1. GRAVITY (NONMOTORIZED) DAMPERS ARE NOT REQUIRED TO BE TESTED TO VERIFY THE AIR LEAKAGE RATING WHEN INSTALLED IN EXHAUST SYSTEMS WHERE THE EXHAUST CAPACITY DOES NOT EXCEED 400 CFM AND THE GRAVITY DAMPER IS PROVIDED WITH A GASKETED SEAL.
2. MOTORIZED DAMPERS ON RETURN AIR OPENINGS IN UNITARY PACKAGED EQUIPMENT THAT HAVE THE MINIMUM LEAKAGE RATE AVAILABLE FROM THE MANUFACTURER.

C403.7.8.4 OUTDOOR AIR INTAKE, RELIEF AND EXHAUST SHUTOFF DAMPERS SHALL BE INSTALLED WITH AUTOMATIC CONTROLS CONFIGURED TO CLOSE WHEN THE SYSTEMS OR SPACES SERVED ARE NOT IN USE OR DURING UNOCCUPIED PERIOD WARM-UP AND SETBACK OPERATION, UNLESS THE SYSTEMS SERVED REQUIRE OUTDOOR OR EXHAUST AIR IN ACCORDANCE WITH THE INTERNATIONAL MECHANICAL CODE OR THE DAMPERS ARE OPENED TO PROVIDE INTENTIONAL ECONOMIZER COOLING. STAIRWAY AND ELEVATOR HOISTWAY SHAFT VENT DAMPERS SHALL BE INSTALLED WITH AUTOMATIC CONTROLS CONFIGURED TO OPEN UPON THE ACTIVATION OF ANY FIRE ALARM INITIATING DEVICE OF THE BUILDING'S FIRE ALARM SYSTEM OF THE INTERRUPTION OF POWER TO THE DAMPER.

C403.10.1.1 DUCTS, SHAFTS AND PLENUMS CONVEYING OUTSIDE AIR FROM THE EXTERIOR OF THE BUILDING TO THE MECHANICAL SYSTEM SHALL MEET ALL AIR LEAKAGE AND BUILDING ENVELOPE INSULATION REQUIREMENTS OF SECTION C402, PLUS BUILDING ENVELOPE VAPOR CONTROL REQUIREMENTS FROM THE INTERNATIONAL BUILDING CODE. EXTENDING CONTINUOUSLY FROM THE BUILDING EXTERIOR TO THE AUTOMATIC SHUTOFF DAMPER OR HEATING OR COOLING EQUIPMENT, FOR THE PURPOSES OF BUILDING ENVELOPE INSULATION REQUIREMENTS, DUCT SURFACES SHALL BE INSULATED WITH THE MINIMUM INSULATION VALUES IN TABLE C403.10.1.1. DUCT SURFACES INCLUDED AS PART OF THE BUILDING ENVELOPE SHALL NOT BE USED IN THE CALCULATION OF MAXIMUM GLAZING AREA AS DESCRIBED IN SECTION C402.4.1. EXCEPTIONS:

1. OUTDOOR AIR DUCTS SERVING INDIVIDUAL SUPPLY AIR UNITS WITH LESS THAN 2,800 CFM OF TOTAL SUPPLY AIR CAPACITY, PROVIDED THESE ARE INSULATED TO THE MINIMUM INSULATION VALUES IN TABLE C403.10.1.1.
2. UNHEATED EQUIPMENT ROOMS WITH COMBUSTION AIR LOUVERS, PROVIDED THEY ARE ISOLATED FROM CONDITIONED SPACE AT SIDES, TOP AND BOTTOM OF THE ROOM WITH R-11 NOMINAL INSULATION.

C403.10.1.2 ALL OTHER SUPPLY AND RETURN AIR DUCTS AND PLENUMS SHALL BE INSULATED WITH A MINIMUM OF R-6 INSULATION WHERE LOCATED IN UNCONDITIONED SPACES, AND WHERE LOCATED OUTSIDE THE BUILDING WITH A MINIMUM OF R-8 INSULATION IN CLIMATE ZONE 4 AND R-12 INSULATION IN CLIMATE ZONE 5, WHERE LOCATED WITHIN A BUILDING ENVELOPE ASSEMBLY, THE DUCT OR PLENUM SHALL BE SEPARATED FROM THE BUILDING EXTERIOR OR UNCONDITIONED OR EXEMPT SPACES BY A MINIMUM INSULATION VALUE AS REQUIRED FOR EXTERIOR WALLS BY SECTION C402.1.3. EXCEPTIONS:

1. WHERE LOCATED WITHIN EQUIPMENT.
2. SUPPLY AND RETURN DUCTWORK LOCATED IN UNCONDITIONED SPACES WHERE THE DESIGN TEMPERATURE DIFFERENCE BETWEEN THE INTERIOR AND EXTERIOR OF THE DUCT OR PLENUM DOES NOT EXCEED 15F AND INSULATED IN ACCORDANCE WITH TABLE C403.10.1.2.

WHERE LOCATED WITHIN CONDITIONED SPACE, SUPPLY DUCTS WHICH CONVEY SUPPLY AIR AT TEMPERATURES LESS THAN 55F OR GREATER THAN 105F SHALL BE INSULATED WITH A MINIMUM INSULATION R-VALUE IN ACCORDANCE WITH TABLE C403.10.1.2. EXCEPTION: DUCTWORK EXPOSED TO VIEW WITHIN A ZONE THAT SERVES THAT ZONE IS NOT REQUIRED TO BE INSULATED.

WHERE LOCATED WITHIN CONDITIONED SPACE, RETURN OR EXHAUST AIR DUCTS THAT CONVEY RETURN OR EXHAUST AIR DOWNSTREAM OF AN ENERGY RECOVERY MEDIA SHALL BE INSULATED WITH A MINIMUM R-VALUE IN ACCORDANCE WITH TABLE C403.10.1.2.

ALL DUCTS, AIR HANDLERS, AND FILTER BOXES SHALL BE SEALED, JOINTS AND SEAMS SHALL COMPLY WITH SECTION 603.9 OF THE INTERNATIONAL MECHANICAL CODE.

C403.10.2 DUCTWORK SHALL BE CONSTRUCTED AND ERECTED IN ACCORDANCE WITH THE INTERNATIONAL MECHANICAL CODE.

C403.10.3 ALL PIPING SERVING AS PART OF A HEATING OR COOLING SYSTEM SHALL BE THERMALLY INSULATED IN ACCORDANCE WITH TABLE C403.10.3. EXCEPTIONS:

1. FACTORY-INSTALLED PIPING WITHIN HVAC EQUIPMENT TESTED AND RATED IN ACCORDANCE WITH A TEST PROCEDURE REFERENCED BY THIS CODE.
2. FACTORY-INSTALLED PIPING WITHIN ROOM FAN-COILS AND UNIT VENTILATORS TESTED AND RATED ACCORDING TO AHRI 440 (EXCEPT THAT THE SAMPLING AND VARIATION PROVISIONS OF SECTION 6.5 SHALL NOT APPLY) AND 840, RESPECTIVELY.
3. PIPING THAT CONVEYS FLUIDS THAT HAVE A DESIGN OPERATING TEMPERATURE RANGE BETWEEN 60F AND 105F.
4. PIPING THAT CONVEYS FLUIDS THAT HAVE NOT BEEN HEATED OR COOLED THROUGH THE USE OF FOSSIL FUELS OR ELECTRIC POWER.
5. STRAINERS, CONTROL VALVES, AND BALANCING VALVES ASSOCIATED WITH PIPING 1 INCH OR LESS IN DIAMETER.
6. DIRECT BURIED PIPING THAT CONVEYS FLUIDS AT OR BELOW 60F.

C403.5 AIR ECONOMIZERS SHALL BE PROVIDED ON ALL NEW COOLING SYSTEMS INCLUDING THOSE SERVING COMPUTER SERVER ROOMS, ELECTRONIC EQUIPMENT, RADIO EQUIPMENT, AND TELEPHONE SWITCHGEAR. ECONOMIZERS SHALL COMPLY WITH SECTIONS C403.5.1 THROUGH C403.5.5. NOTE: ECONOMIZERS ARE NOT REQUIRED FOR SYSTEMS THAT MEET THE REQUIREMENTS OF SECTION C403.5, EXCEPTIONS 1 THROUGH 11.

C403.5.1 ECONOMIZER SYSTEMS SHALL BE INTEGRATED WITH THE MECHANICAL COOLING SYSTEM AND BE CONFIGURED TO PROVIDE PARTIAL COOLING EVEN WHERE ADDITIONAL MECHANICAL COOLING IS REQUIRED TO PROVIDE THE REMAINDER OF THE COOLING LOAD. CONTROLS SHALL NOT BE CAPABLE OF CREATING A FALSE LOAD IN THE MECHANICAL COOLING SYSTEM BY LIMITING OR DISABLING THE ECONOMIZER OR ANY OTHER MEANS, SUCH AS HOT GAS BYPASS, EXCEPT AT THE LOWEST STAGE OF MECHANICAL COOLING. UNITS THAT INCLUDE AN AIR ECONOMIZER SHALL COMPLY WITH THE FOLLOWING:

1. UNIT CONTROLS SHALL HAVE THE MECHANICAL COOLING CAPACITY CONTROL INTERLOCKED WITH THE AIR ECONOMIZER CONTROLS SUCH THAT THE OUTDOOR AIR DAMPER IS AT THE 100 PERCENT OPEN POSITION WHEN MECHANICAL COOLING IS ON AND THE OUTDOOR AIR DAMPER DOES NOT BEGIN TO CLOSE TO PREVENT COIL FREEZING DUE TO MINIMUM COMPRESSOR RUN TIME UNTIL THE LEAVING AIR TEMPERATURE IS LESS THAN 45F;
2. DIRECT EXPANSION (DX) UNITS WITH COOLING CAPACITY 65,000 BTUH OR GREATER OF RATED CAPACITY SHALL COMPLY WITH THE FOLLOWING:
 3. 2.1 DX UNITS THAT CONTROL THE CAPACITY OF THE MECHANICAL COOLING DIRECTLY BASED ON OCCUPIED SPACE TEMPERATURE SHALL HAVE NOT FEWER THAN TWO STAGES OF MECHANICAL COOLING CAPACITY.
 4. 2.2 OTHER DX UNITS, INCLUDING THOSE THAT CONTROL SPACE TEMPERATURE BY MODULATING THE AIRFLOW TO THE SPACE, SHALL BE IN ACCORDANCE WITH TABLE C403.5.1.

C403.5.2 HVAC SYSTEM DESIGN AND ECONOMIZER CONTROLS SHALL BE SUCH THAT ECONOMIZER OPERATION DOES NOT INCREASE BUILDING HEATING ENERGY USE DURING NORMAL OPERATION. EXCEPTION: ECONOMIZERS ON VAV SYSTEMS THAT CAUSE ZONE LEVEL HEATING TO INCREASE DUE TO A REDUCTION IN SUPPLY AIR TEMPERATURE. C403.5.3.1 AIR ECONOMIZER SYSTEMS SHALL BE CONFIGURED TO MODULATE OUTDOOR AIR AND RETURN AIR DAMPERS TO PROVIDE UP TO 100 PERCENT OF THE DESIGN SUPPLY AIR QUANTITY AS OUTDOOR AIR FOR COOLING.

C403.5.3.2 ECONOMIZER CONTROLS AND DAMPERS SHALL BE CONFIGURED TO SEQUENCE THE DAMPERS WITH MECHANICAL COOLING EQUIPMENT AND SHALL NOT BE CONTROLLED BY ONLY MIXED AIR TEMPERATURE. AIR ECONOMIZERS ON SYSTEMS WITH COOLING CAPACITY GREATER THAN 65,000 BTUH SHALL BE CONFIGURED TO PROVIDE PARTIAL COOLING EVEN WHEN ADDITIONAL MECHANICAL COOLING IS REQUIRED TO MEET THE REMAINDER OF THE COOLING LOAD. EXCEPTION: THE USE OF MIXED AIR TEMPERATURE LIMIT CONTROL SHALL BE PERMITTED FOR SYSTEMS THAT ARE BOTH CONTROLLED FROM SPACE TEMPERATURE (SUCH AS SINGLE ZONE SYSTEMS) AND HAVING COOLING CAPACITY LESS THAN 65,000 BTUH.

C403.5.3.3 AIR ECONOMIZERS SHALL BE CONFIGURED TO AUTOMATICALLY REDUCE OUTDOOR AIR INTAKE TO THE DESIGN MINIMUM OUTDOOR AIR QUANTITY WHEN OUTDOOR AIR INTAKE WILL NO LONGER REDUCE COOLING ENERGY USAGE. HIGH-LIMIT SHUTOFF CONTROL TYPES SHALL BE CHOSEN FROM TABLE C403.5.3.3. HIGH-LIMIT SHUTOFF CONTROL SETTINGS FOR THESE CONTROL TYPES SHALL BE THOSE SPECIFIED TO TABLE C403.5.3.3.

C403.5.3.4 SYSTEMS SHALL BE CAPABLE OF RELIEVING EXCESS OUTDOOR AIR DURING AIR ECONOMIZER OPERATION TO PREVENT OVER-PRESSURIZING THE BUILDING. THE RELIEF AIR OUTLET SHALL BE LOCATED TO AVOID RECIRCULATION INTO THE BUILDING.

C403.5.3.5 RETURN, EXHAUST/RELIEF AND OUTDOOR AIR DAMPERS USED IN ECONOMIZERS SHALL COMPLY WITH SECTION C403.7.8.

C409.1 ALL NEW BUILDINGS AND ADDITIONS SHALL HAVE THE CAPABILITY OF METERING SOURCE ENERGY FOR ON-SITE RENEWABLE ENERGY PRODUCTION IN ACCORDANCE WITH SECTION C409.2.4 AND THE END-USE ENERGY USAGE FOR ELECTRIC VEHICLE CHARGING IN ACCORDANCE WITH SECTION C409.3.4. NEW BUILDINGS AND ADDITIONS WITH A GROSS CONDITIONED FLOOR AREA OVER 50,000 SQUARE FEET SHALL COMPLY WITH SECTION C409. BUILDINGS SHALL BE EQUIPPED TO MEASURE, MONITOR, RECORD AND DISPLAY ENERGY CONSUMPTION DATA FOR EACH ENERGY SOURCE AND END USE CATEGORY PER THE PROVISIONS OF THIS SECTION, TO ENABLE EFFECTIVE ENERGY MANAGEMENT. EXCEPTIONS:

1. TENANT SPACES SMALLER THAN 50,000 SQUARE FEET WITHIN BUILDINGS IF TENANT SPACE HAS ITS OWN UTILITY SERVICE AND UTILITY METERS.
2. BUILDINGS IN WHICH THERE IS NO GROSS CONDITIONED FLOOR AREA OVER 25,000 SQUARE FEET, INCLUDING BUILDING COMMON AREA, THAT IS SERVED BY ITS OWN UTILITY SERVICES AND METERS.

RESIDENTIAL ENERGY CODE


1. WHOLE-HOUSE FAN EFFICACY PER TABLE R403.6.1.
2. EQUIPMENT AND APPLIANCE SIZING PER R403.7, HEATING AND COOLING EQUIPMENT AND APPLIANCES SHALL BE SIZED IN ACCORDANCE WITH ACCA MANUAL S OR OTHER APPROVED SIZING METHODOLOGIES BASED ON BUILDING LOADS CALCULATED IN ACCORDANCE WITH ACCA MANUAL J OR OTHER APPROVED HEATING AND COOLING CALCULATION METHODOLOGIES
3. ELECTRIC RESISTANCE ZONE PER R403.7.1, ELECTRIC ZONAL HEATING AS PRIMARY HEAT SOURCE SHALL INSTALL DUCTLESS MINI-SPLIT HEAT PUMP IN THE LARGEST ZONE IN THE DWELLING UNLESS TOTAL INSTALLED HEATING CAPACITY OF 2 KW PER DWELLING OR LESS.
4. PROVIDED ONE THERMOSTAT FOR EACH HEATING AND COOLING SYSTEM PER R403.1.
5. PER R403.3.6, SUPPLY AND RETURN DUCTS IN CEILING INSULATION SHALL HAVE MIN R-8 INSULATION ALL AROUND. THE SUM OF THE CEILING INSULATION OF THE TOP AND BELOW OF THE DUCT SHALL BE MIN R-19, EXCLUDING THE R-VALUE OF THE DUCT INSULATION.
6. MECHANICAL SYSTEM PIPING CARRYING FLUIDS ABOVE 105F OR BELOW 55F SHALL BE INSULATED WITH MIN R-6 PER R403.4. INSULATION SHALL BE PROTECTED FROM DAMAGE AND SHALL PROVIDE SHIELDING FROM SOLAR RADIATION. ADHESIVE TAPE SHALL NOT BE PERMITTED.

DUCT INSULATION SCHEDULE			
	SERVICE (1)(3)(4)(5)	MATERIAL (6)	R-VALUE (MIN. INSTALLED)
WSEC	SUPPLY & RETURN AIR DUCTS IN UNCONDITIONED SPACE	MINERAL-WOOL BLANKET	6.0
	SUPPLY & RETURN AIR DUCTS LOCATED OUTSIDE THE BUILDING	MINERAL-WOOL BLANKET	8.0
	SUPPLY WITH SA TEMP <55F OR >105F WITHIN CONDITIONED SPACE	MINERAL-WOOL BLANKET	3.3
	SUPPLY DUCTS EXPOSED WITHIN CONDITIONED SPACE	MINERAL-WOOL BLANKET	0.0
WSMC	OUTSIDE AIR FROM EXTERIOR OF BUILDING TO AUTOMATIC SHUT-OFF DAMPER OR HEATING OR COOLING EQUIPMENT AND GREATER THAN 2,800 CFM	MINERAL-WOOL BLANKET	NOTE 2
	OUTSIDE AIR FROM EXTERIOR OF BUILDING TO AUTOMATIC SHUT-OFF DAMPER OR HEATING OR COOLING EQUIPMENT AND LESS THAN 2,800 CFM	MINERAL-WOOL BLANKET	7.0
	OUTSIDE AIR DUCT IN UNHEATED EQUIPMENT ROOMS WITH COMBUSTION AIR LOUVERS, ISOLATED FROM CONDITIONED SPACE AT SIDES, TOP AND BOTTOM WITH R-11 INSULATION	MINERAL-WOOL BLANKET	0.0
	OUTSIDE AIR DUCT IN CONDITION SPACE	MINERAL-WOOL BLANKET	4.0
WSMC	FOR HEAT OR ENERGY RECOVERY VENTILATION SYSTEM, DUCT UPSTREAM OF HEAT EXCHANGER	MINERAL-WOOL BLANKET	4.0
	EXHAUST DUCTS IN UNCONDITIONED SPACE	MINERAL-WOOL BLANKET	4.0

- NOTES
- (1) DUCT INSULATION SHALL COMPLY WITH WSMC AND WSEC
 - (2) DUCT SHALL MEET THE REQUIREMENTS OF METAL FRAMED WALLS PER WSEC TABLE C402.1.4
 - (3) VAPOR RETARDER IS INSTALLED ON SUPPLY DUCT THAT DOES COOLING AND OUTSIDE AIR DUCT PER WSMC 604.11
 - (4) EXTERNAL DUCT INSULATION IS IDENTIFIABLE PER WSMC 604.7
 - (5) ALL DUCTWORK IS CONSTRUCTED AND SEALED PER WSMC
 - (6) INSULATION SHALL HAVE A MAXIMUM FLAME SPREAD INDEX OF 25 AND MAXIMUM SMOKE DEVELOPED INDEX OF 50 PER WSMC 604.3

TABLE C403.10.3: MINIMUM PIPE INSULATION THICKNESS							
FLUID OPERATING TEMPERATURE RANGE AND USAGE (°F)	INSULATION CONDUCTIVITY		ELECTRICAL				
	CONDUCTIVITY BTU·IN/(H·FT²·°F)	MEAN RATING TEMPERATURE, °F	< 1	1 TO < 1-1/2	1-1/2 TO < 4	4 TO < 8	≥ 8
> 350	0.32 – 0.34	250	4.5	5.0	5.0	5.0	5.0
251 – 350	0.29 – 0.32	200	3.0	4.0	4.5	4.5	4.5
201 – 250	0.27 – 0.30	150	2.5	2.5	2.5	3.0	3.0
141 – 200	0.25 – 0.29	125	1.5	1.5	2.0	2.0	2.0
105 – 140	0.21 – 0.28	100	1.0	1.0	1.5	1.5	1.5
40 – 60	0.21 – 0.27	75	0.5	0.5	1.0	1.0	1.0
< 40	0.20 – 0.26	75	0.5	1.0	1.0	1.0	1.5

NO.	DATE	DESCRIPTION	PERMIT RESUBMITTAL #2	REVISIONS
1	8/29/25			



DRAWN:	OF
DESIGNED: ABE	CHECKED: PR
CHECKED: PR	APPROVED: JMR

PROJECT: EAST TOWN CROSSING BUILDING A MULTIFAMILY DEVELOPMENT PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W. SUITE 302
LYNNWOOD, WA 98036
PHONE: (206) 364-3343
REPROJECT NO.: 810010
CONTACT: ARK@ESPINELI

DATE: 08/29/2025


SHEET TITLE: PROJECT NOTES

SHEET NO. **M0.1**

City of Puyallup
Development & Permitting Services


ISSUED PERMIT

Building	Planning
Engineering	Public Works
Fire	Traffic

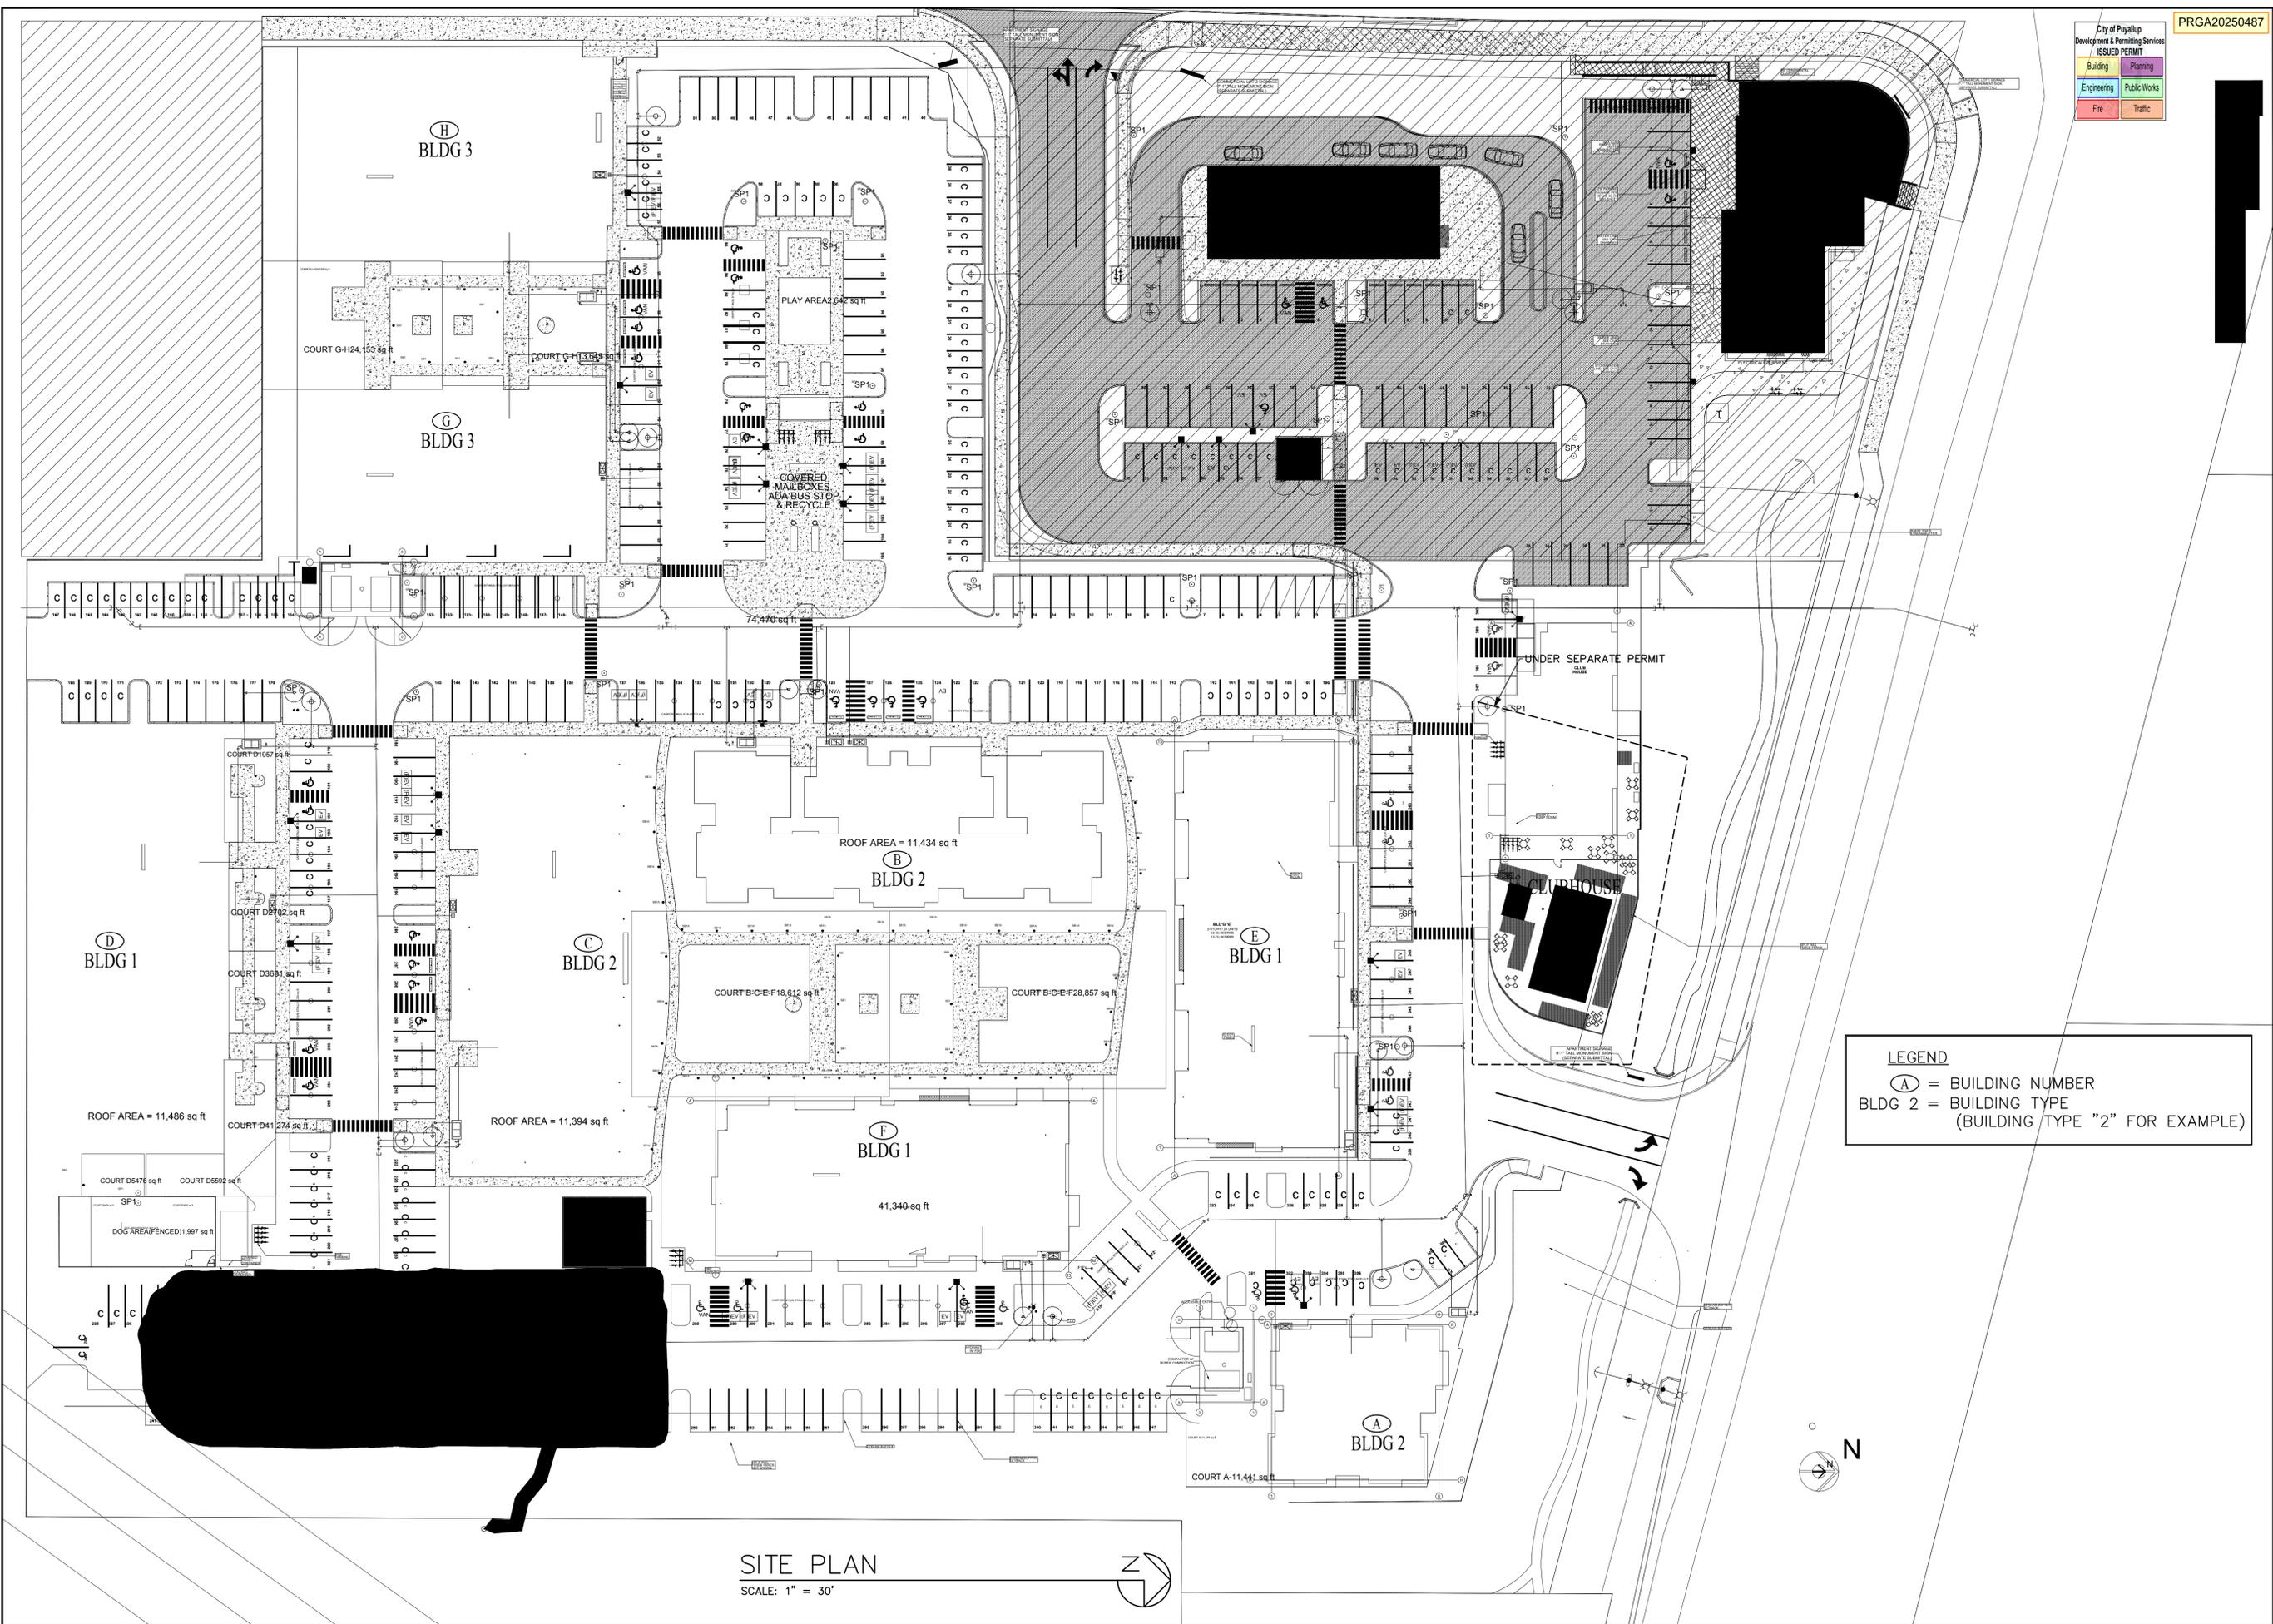

PRGA20250487	
NO.	DESCRIPTION
1	PERMIT RESUBMITTAL #2
DATE	8/29/25
DRAWN:	OP
DESIGNED:	ABE
CHECKED:	PR
APPROVED:	JMR
PROJECT: EAST TOWN CROSSING BUILDING A MULTIFAMILY DEVELOPMENT PIONEER WAY & SHAW RD. PUYALLUP, WA	
<small>19401 40TH AVE W. SUITE 302 LYNNWOOD, WA 98036 PHONE: (206) 364-3343 RE/PROJECT NO.: 810010 CONTACT: ARK@ESFINELI</small>	
DATE:	08/29/2025
SHEET TITLE:	SITE PLAN
SHEET NO.	M1.0

NO.	DATE	DESCRIPTION	PERMIT RESUBMITTAL #2
1	8/29/25		



DRAWN: OP	DESIGNED: ABE	CHECKED: PR	APPROVED: JMR
-----------	---------------	-------------	---------------

PROJECT: EAST TOWN CROSSING BUILDING A
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206.864.3343
RE: PROJECT NO. 810010
CONTACT: ARK.ESPINELLI

ROBISON ENGINEERING, INC.

DATE: 08/29/2025

SHEET TITLE:
HVAC PLAN - LEVEL 1

SHEET NO.
M2.0

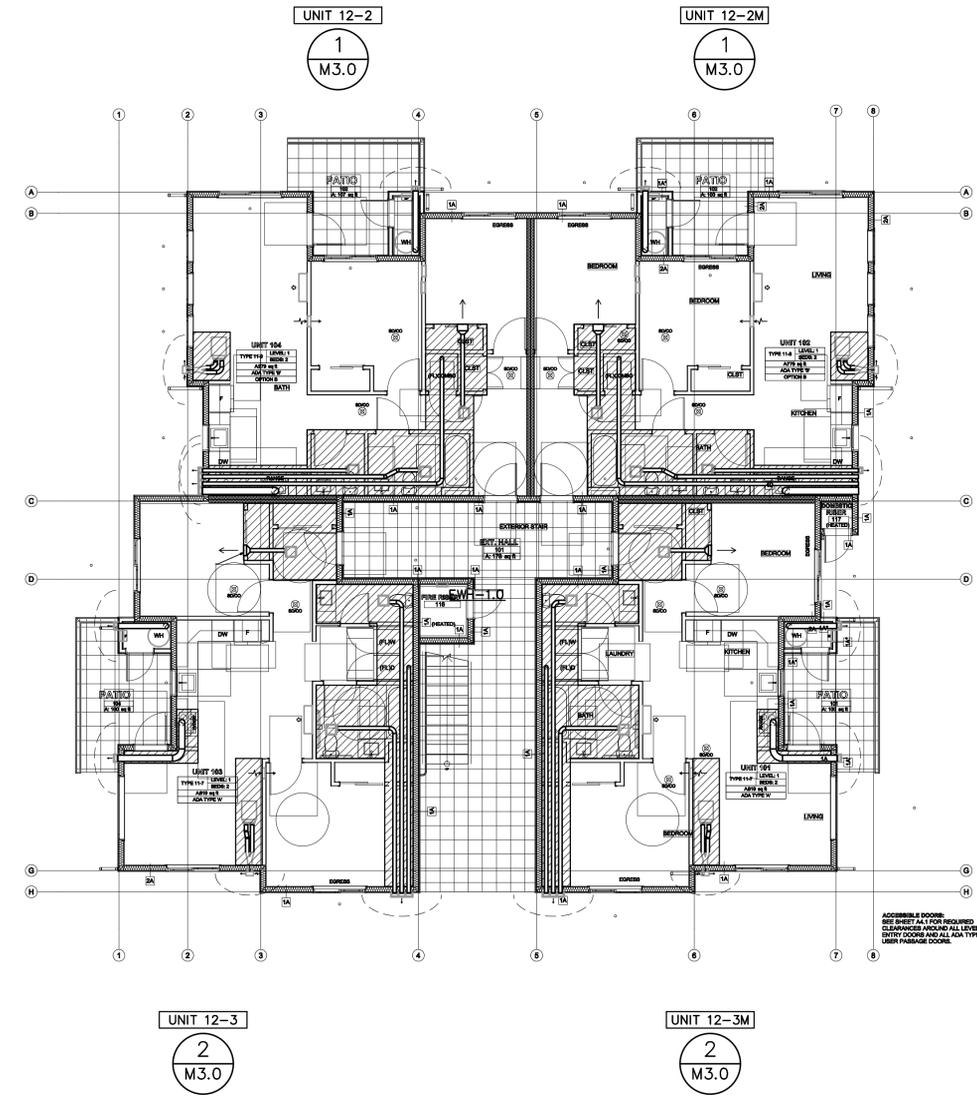

PHASE 2 - BUILDING A

DESCRIPTION: 10 UNIT APARTMENT BUILDING
APR. 2024 BUILDING CODE 2018 IRC
OCCUPANCY: R2
TYPE OF CONSTRUCTION: 1B
FIRE RESISTANCE: YES, WPPA 1HR PER R02.1.2
*NEED AT DECK & DECK STORAGE

FIRE ALARM SYSTEM AND SMOKE ALARMS YES
ELEVATOR: NO
NUMBER OF APARTMENT UNITS: 10 (PER BUILDING)
NUMBER OF (1) BEDROOMS: 18
NUMBER OF (2) BEDROOMS: 2
ACCESSIBLE TYPE A UNITS REQUIRED: 1
ACCESSIBLE TYPE B UNITS REQUIRED: 3

BASE ALLOWABLE BUILDING AREA, HEIGHT AND STORAGE:
ALLOWABLE AREA TYPE 4P
ALLOWABLE MAXIMUM HEIGHT: 60A
ALLOWABLE STORIES: 3

INDICATORS TO THE BASE ALLOWABLE AREA BUILDING IS:
MODIFICATIONS NOT NECESSARY

*FOR SINGLE-OCCUPANCY, MULTI-STORY BUILDING
SEE PRO RATA CALCULATION FOR AREA INCREASE ON SHEET B20.2

PROPOSED HEIGHT: 38.4 MAX. PER PMG
PROPOSED STORIES: 3

TOTAL PROPOSED GROSS AREA ALL LEVELS (INCLUDES DECK):

LEVEL 1:	3,840 SF
LEVEL 2:	3,840 SF
LEVEL 3:	3,840 SF
TOTAL:	11,520 SF


OCCUPANT LOAD:
OCCUPANT LOAD FACTOR: 200 DEBRS
OCCUPANT LOAD PER LEVEL:
LEVEL 1: 18
LEVEL 2: 18
LEVEL 3: 18

RESIDENTIAL UNIT NOTES:

UNIT A = UNIT TYPE A (FOR EXAMPLE)
REFER TO DWG M3.0, DETAIL 1.


FOR DUCT SIZES WITHIN THE RESIDENTIAL UNITS, REFER TO THE ENLARGED UNIT PLANS ON DWGS M3.0-M303.

BUILDING TYPE 1
LEVEL 1 FLOOR PLAN
SCALE: 1/8" = 1'-0"

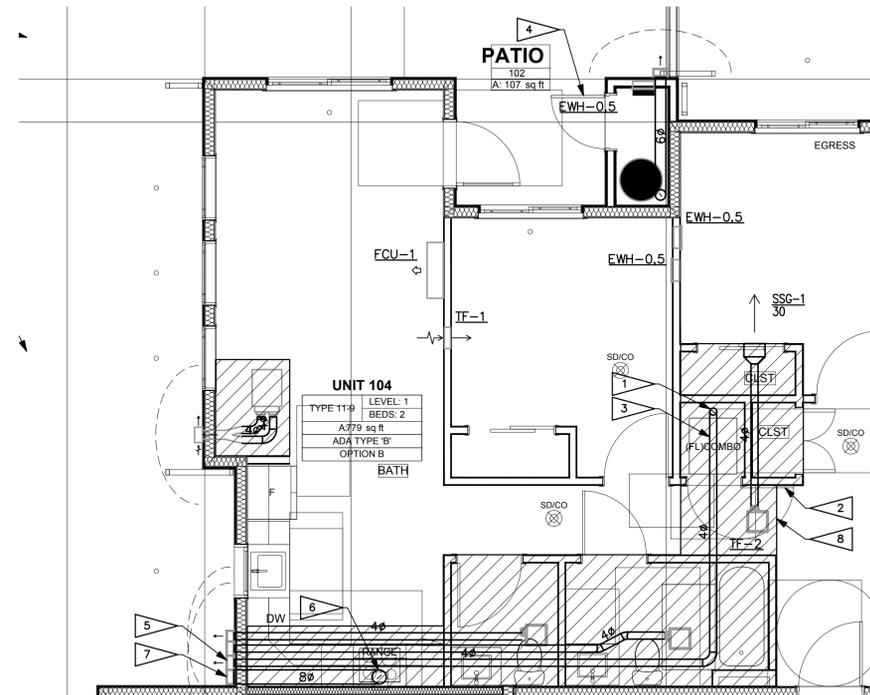

- RESIDENTIAL UNIT NOTES:**
- PENETRATIONS OF THE RATED WALL ASSEMBLIES SHALL BE PROTECTED IN ACCORDANCE WITH IBC SECTION 717. REFER TO ARCHITECTURAL PLANS FOR PENETRATION DETAILS.
 - PER OWNER, THE FOLLOWING RANGE HOODS ARE BEING INSTALLED: STANDARD UNITS (MICRO/HOOD COMBO): FRIGIDAIRE LFMV1846VF ADA UNITS (HOOD ONLY): GE JVX3240DJWW PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS, DUCT CONNECTION TO HOODS ARE 6". MINIMUM SIZE ROUND DUCT FOR HOOD VENTING SHALL BE 7".
 - ENERGY RECOVERY VENTILATOR ERV-1 SHALL SERVE AS THE WHOLE HOUSE VENTILATION FAN. REFER TO M0.2 FOR REQUIREMENTS.
 - DRYER VENTING: PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS, THE MAXIMUM LENGTH OF THE DRYER VENTS IS AS FOLLOWS (REFER TO DWG M4.0, DETAIL 1):

NO.	DATE	DESCRIPTION
1	8/29/25	PERMIT RESUBMITAL #2




OP	DESIGNED:	CHECKED:	APPROVED:
DRAWN:	ABE	PR	JMR

**UNIT 11-8, 21-7M,
ENLARGED PLAN**

SCALE: 1/4" = 1'-0"

1
M3.0

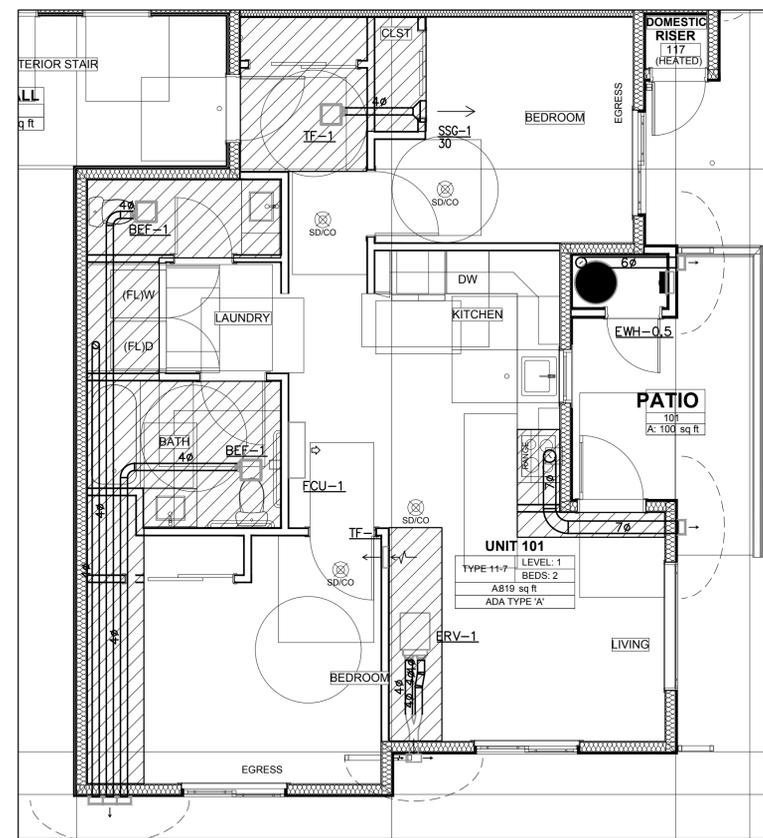

FLAG NOTES:

- 4" POC TO DRYER. PROVIDE METAL DRYER BOX WHERE DUCT IS ROUTED IN 2X6 FRAMED WALL. REFER TO MANUFACTURER'S INSTALLATION INSTRUCTIONS AND WSMC 504.8.4.1 FOR THE MAXIMUM ALLOWED LENGTH OF THE DRYER VENT. PROVIDE PERMANENT PLACARD OF TYPE PLAC34 SHOWING NET EQUIVALENT LENGTH. DUCT SHALL REMAIN SEPARATE FROM OTHER EXHAUST SYSTEMS UP TO TERMINATION.
- CLOSETS CONTAINING DRYERS SHALL BE PROVIDED WITH LOUVERED DOOR OR 100 SQ. IN FREE-AREA OPENING ABOVE DOOR. OPENING PROVIDES PATH FOR EXHAUST AIR DURING WASHER OPERATION PER WSMC TABLE 403.3.1.1 NOTE (I) AND MAKEUP AIR DURING DRYER OPERATION PER 504.6.
- DRYER EXHAUST VENT SHALL BE PROTECTED WITH FIRE WRAP FROM DRYER TO EXTERIOR WALL TERMINATION POINT. REFER TO DWG M401, DETAIL 1 FOR FIRE WRAP DETAILS. FIRE WRAP SHALL BE UNIFRAX FYREWRAP DPS.
- LOUVERED DOOR. PROVIDE LOUVER WITH MINIMUM 130SQIN. LOUVER TO BE INSTALLED PER MANUFACTURER.
- 4" DRYER EXHAUST TERMINATION WALL CAP. PROVIDE BACKDRAFT DAMPER AT TERMINATION. DO NOT INSTALL SCREENS ON DRYER EXHAUST TERMINATIONS. CLEARANCES PER GENERAL NOTE 1.
- POC TO DOMESTIC KITCHEN RANGE HOOD. SEE PLANS FOR SIZE. DUCT SHALL REMAIN SEPARATE FROM OTHER EXHAUST SYSTEMS UP TO TERMINATION.
- DOMESTIC KITCHEN RANGE HOOD EXHAUST TERMINATION WALL CAP WITH SCREEN. PROVIDE BACKDRAFT DAMPER AT TERMINATION. CLEARANCES PER GENERAL NOTE 1.
- LOWERED SOFFIT FOR MECHANICAL EQUIPMENT.

PROJECT: EAST TOWN CROSSING BUILDING A
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

CONTACT: ARK/ESPINELLI

DATE: 08/29/2025

DATE:
08/29/2025

SHEET TITLE:
HVAC ENLARGED
PLANS

SHEET NO.
M3.0

ADA DRYER

GFV55ESSN

GE® Long Vent 7.8 cu. ft. Capacity Front Load Electric Dryer

DIMENSIONS AND INSTALLATION INFORMATION (IN INCHES)


ELECTRIC DRYER RATING	
120V/240V	5600W, 25A, 60Hz
120V/208V	4300W, 23A, 60Hz

EXHAUST OPTIONS: 4-way via rear, right, left and bottom.

CIRCUIT REQUIREMENTS: An individual, properly grounded branch circuit, protected by a 30-amp circuit breaker or a time-delay fuse, is required.

NOTE: Dryer wall outlet must be located within 36" of service cord entry and accessible when dryer is mounted in position.

INSTALLATION INFORMATION: For complete information, see installation instructions packed with your dryer.

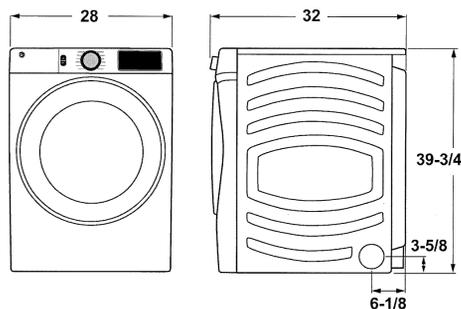

For answers to your Monogram, GE Café® Series, GE Profile® Series or GE Appliances product questions, visit our website at geappliances.com or call GE Answer Center® Service, 800.626.2000.



Specification Revised 11/19

STANDARD DRYER

GUV27ESSM


GE® Unitized Spacemaker® 3.8 DOE Cu. Ft. Stainless Steel Washer and 5.9 Cu. Ft. Long Vent Electric Dryer

DIMENSIONS AND INSTALLATION INFORMATION (IN INCHES)

ELECTRICAL REQUIREMENTS: This appliance should be connected to an individual, properly grounded branch circuit with 120/240V or 120/208V single-phase 60 Hz electrical service and should be protected by 30-amp time-delay fuses or circuit breakers KW Rating per voltage (240/208). This appliance is manufactured with neutral connected to the frame. Power cord should be purchased separately. Dryers must be exhausted to the outside.

INSTALLATION INFORMATION: For complete information, see installation instructions packed with the product.

Installation Instructions

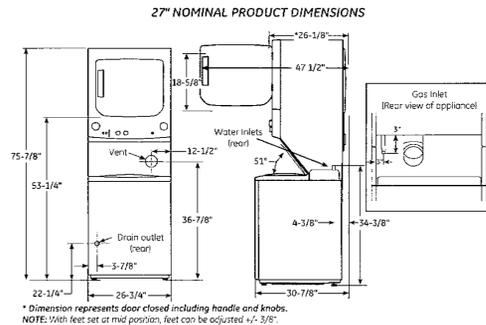

For answers to your Monogram, GE Café® Series, GE Profile® Series or GE Appliances product questions, visit our website at geappliances.com or call GE Answer Center® Service, 800.626.2000.



Specification Revised 11/17

GFV55ESSN

GE® Long Vent 7.8 cu. ft. Capacity Front Load Electric Dryer

DRYER EXHAUSTING INFORMATION - METAL DUCT ONLY

For complete information, see installation instructions packed with your dryer.

DUCTING MATERIALS: For best performance, this dryer should be vented with 4" diameter all rigid metal exhaust duct. If rigid metal duct cannot be used, then UL-listed flexible metal (semi-rigid) ducting can be used (Kit WX0830077). In special installations, it may be necessary to connect the dryer to the house vent using a flexible metal (foil-type) duct. A UL-listed flexible metal (foil-type) duct may be used ONLY in installations where rigid metal or flexible metal (semi-rigid) ducting cannot be used AND where a 4" diameter can be maintained throughout the entire length of the transition duct. Please see installation instruction packed with your dryer for complete instructions when using flexible metal (foil type) ducting.

EXHAUST LENGTH CALCULATION:

- Determine the number of 90° turns needed for your installation. If you exhaust to the side or bottom of dryer, add one turn.
- The maximum length of 4" rigid (aluminum or galvanized) duct which can be tolerated is shown in the table.

A turn of 45° or less may be ignored. Two 45° turns within the duct length should be treated as a 90° elbow.


A turn over 45° should be treated as a 90° elbow. Dryers must be exhausted to the outside.

CAUTION: For personal safety do not terminate exhaust into a chimney, under any enclosed house floor (crawl space), or into an attic, since the accumulated lint could create a fire hazard or moisture could cause damage. Never terminate the exhaust into a common duct or plenum with a kitchen exhaust, since the combination of lint and grease could create a fire hazard.

Exhaust ducts should be terminated in a dampered wall cap to prevent back drafts, bird nesting, etc. The wall cap must also be located at least 12" above the ground or any other obstruction with the opening pointed down.

FOR MORE INFORMATION ON VENTING KITS AND ACCESSORIES, PLEASE CALL 1-800-GE-CARES.

Domestic dryer models	Number of 90° turns	Best performance Maximum length of 4" dia. rigid metal duct Exhaust hood type	
		A 4" opening	B 2-1/2" opening
A 4" B 2-1/2"	0	200 ft.	175 ft.
	1	185 ft.	165 ft.
	2	175 ft.	155 ft.
	3	165 ft.	145 ft.
	4	155 ft.	135 ft.



For answers to your Monogram, GE Café® Series, GE Profile® Series or GE Appliances product questions, visit our website at geappliances.com or call GE Answer Center® Service, 800.626.2000.



Specification Revised 11/19

GUV27ESSM

GE® Unitized Spacemaker® 3.8 DOE Cu. Ft. Stainless Steel Washer and 5.9 Cu. Ft. Long Vent Electric Dryer

DIMENSIONS AND INSTALLATION INFORMATION (IN INCHES)

For complete information, see installation instructions packed with your dryer.

DUCTING MATERIALS:

For best performance, this dryer should be vented with 4" diameter all rigid metal exhaust duct. If rigid metal duct cannot be used, then UL-listed flexible metal (semi-rigid) ducting can be used (Kit WX0830077). In special installations, it may be necessary to connect the dryer to the house vent using a flexible metal (foil-type) duct. A UL-listed flexible metal (foil-type) duct may be used ONLY in installations where rigid metal or flexible metal (semi-rigid) ducting cannot be used AND where a 4" diameter can be maintained throughout the entire length of the transition duct. Please see installation instruction packed with your dryer for complete instructions when using flexible metal (foil type) ducting.

EXHAUST LENGTH CALCULATION:

- Determine the number of 90° turns needed for your installation. If you exhaust to the side or bottom of dryer, add one turn.
- The maximum length of 4" rigid (aluminum or galvanized) duct which can be tolerated is shown in the table.

For every extra 90° elbow, reduce the allowable vent system length by 10 ft. Two 45° elbows will be treated like one 90° elbow. For the side exhaust installations, add one 90° elbow to the chart. The total vent system length includes all the straight portions and elbows of the system (transition duct included).

Dryers must be exhausted to the outside.

CAUTION: For personal safety do not terminate exhaust into a chimney, under any enclosed house floor (crawl space), or into an attic, since the accumulated lint could create a fire hazard or moisture could cause damage. Never terminate the exhaust into a common duct or plenum with a kitchen exhaust, since the combination of lint and grease could create a fire hazard.

Exhaust ducts should be terminated in a dampered wall cap to prevent back drafts, bird nesting, etc. The wall cap must also be located at least 12" above the ground or any other obstruction with the opening pointed down.



For answers to your Monogram, GE Café® Series, GE Profile® Series or GE Appliances product questions, visit our website at geappliances.com or call GE Answer Center® Service, 800.626.2000.




Specification Revised 11/17

GUV27 DRYER EXHAUST LENGTH

No. of 90° Elbows	RECOMMENDED MAXIMUM LENGTH	
	Rigid Metal	Rigid Metal
0	200 Feet	175 Feet
1	185 Feet	165 Feet
2	175 Feet	155 Feet
3	165 Feet	145 Feet
4	155 Feet	135 Feet
5	145 Feet	125 Feet

SAMPLE LABEL

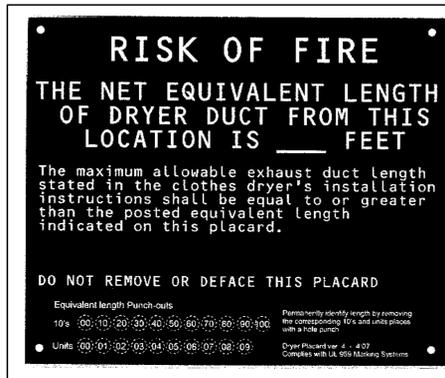


NOTE:

DRYER MAKE AND MODEL SHOWN ARE THE BASIS OF DESIGN FOR DETERMINING MAXIMUM DRYER VENT LENGTHS. IF A DIFFERENT MAKE/MODEL IS USED, NOTIFY THE ENGINEER AND ARCHITECT IMMEDIATELY TO VERIFY VENT LENGTHS AND TO DETERMINE IF DRYER BOOSTER FANS WILL BE NECESSARY.

PER IMC 504.8.5, CONTRACTOR SHALL PROVIDE A LABEL OR PLACARD WITHIN 6 FEET OF THE EXHAUST DUCT CONNECTION THAT LISTS THE EQUIVALENT LENGTH OF THE DRYER EXHAUST DUCT. SEE SAMPLE LABEL FOR DETAILS.

NO.	DATE	DESCRIPTION
1	8/29/25	PERMIT RESUBMITAL #2



DRAWN:	OP
DESIGNED:	ABE
CHECKED:	PR
APPROVED:	JMR

PROJECT: EAST TOWN CROSSING BUILDING A
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA
 18401 ACOTHAVE W. SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 964-3343
 RE/PROJECT NO.: 810010
 CONTACT: ARK.ESPINELLI

DATE:
08/29/2025

SHEET TITLE:
DETAILS & DIAGRAMS

SHEET NO.
M4.1

PLUMBING TABLES

PIPE INSULATION SCHEDULE

SERVICE	OPTION 1		OPTION 2		VAPOR RETARDER REQUIRED	NOTES
	MATERIAL	THICKNESS	MATERIAL	THICKNESS		
DOMESTIC COLD WATER, IRRIGATION WATER, CONDENSATE DRAINS, STORM DRAIN (IN CONDITIONED SPACE)	MINERAL-FIBER WITH JACKET	ALL SIZES: 1/2"	PVC/NBR	ALL SIZES: 3/8"	YES	12,13
DOMESTIC COLD WATER, IRRIGATION WATER, CONDENSATE DRAINS, WASTE (OUTSIDE THE CONDITIONED SPACE)	MINERAL-FIBER WITH JACKET	(R-3) 1/2" PIPE: 1/2" ALL OTHER SIZES: 1"	PVC/NBR	(R-3) 1/2" PIPE: 1/2" ALL OTHER SIZES: 3/4"	YES	7,8,10
ROOF DRAIN BODIES	MINERAL-FIBER OR CELLULAR GLASS WITH JACKET	1"	PVC/NBR	1"	YES	12
DOMESTIC HOT WATER AND RECIRCULATED HOT WATER (RESIDENTIAL)	MINERAL-FIBER WITH JACKET	(R-3) 1/2" PIPE: 1/2" ALL OTHER SIZES: 1"	PVC/NBR	(R-3) 1/2" PIPE: 1/2" ALL OTHER SIZES: 3/4"	NO	2,10
DOMESTIC HOT WATER AND RECIRCULATED HOT WATER (NONRESIDENTIAL)	MINERAL-FIBER WITH JACKET	1/2"-1 1/4" PIPE: 1" 1 1/2"-4" PIPE: 1.5"	PVC/NBR	1/2"-1 1/4" PIPE: 1" 1 1/2"-4" PIPE: 1.5"	NO	3,9
EXPOSED SANITARY DRAINS AND DOMESTIC WATER SUPPLIES AND STOPS FOR ADA FIXTURES.	TRUEBRO LAV-GUARD	N/A	N/A	N/A	NO	11

- NOTES:**
- PIPING INSULATION EXPOSED TO THE WEATHER SHALL BE PROTECTED FROM DAMAGE. CONTRACTOR SHALL PROVIDE SHIELDING FROM SOLAR RADIATION THAT CAN CAUSE DEGRADATION OF THE MATERIAL. ADHESIVE TAPE SHALL NOT BE PERMITTED.
 - PER 2021 WSEC SECTION R403.5.3 (RESIDENTIAL) INSULATION FOR HOT WATER PIPE SHALL HAVE A MINIMUM R-VALUE OF R-3.
 - PIPING FROM WATER HEATER TO THE TERMINATION OF HEATED WATER SUPPLY PIPE SHALL BE INSULATED IN ACCORDANCE WITH TABLE C403.2.9.
 - ON BOTH THE INLET AND OUTLET PIPING OF A STORAGE HOT WATER HEATER, THE FIRST 8 FEET OF PIPING OR PIPING FROM WATER HEATER TO HEAT TRAP SHALL BE INSULATED.
 - HEAT TRACED PIPING SHALL BE INSULATED IN THE SAME MANNER AS NON HEAT TRACED PIPING OR PER THE HEAT TRACE MANUFACTURER'S INSTRUCTIONS.
 - TUBULAR PIPING INSULATION SHALL NOT BE REQUIRED FOR THE FOLLOWING:
 - THE TUBING FROM THE CONNECTION AT THE TERMINATION OF THE FIXTURE SUPPLY PIPING TO A PLUMBING FIXTURE OR PLUMBING APPLIANCE.
 - VALVES, PUMPS, STRAINERS, AND THREADED UNIONS IN PIPING THAT IS 1 INCH OR LESS IN NOMINAL DIAMETER.
 - PIPING FROM USER-CONTROLLED SHOWER AND BATH MIXING VALVES TO THE WATER OUTLETS.
 - COLD WATER PIPING OF A DEMAND RECIRCULATION WATER SYSTEM.
 - TUBING FROM A HOT DRINKING-WATER HEATING UNIT TO THE WATER OUTLET.
 - PIPING AT LOCATIONS WHERE A VERTICAL SUPPORT OF THE PIPING IS INSTALLED.
 - PIPING SURROUNDED BY BUILDING INSULATION WITH A THERMAL RESISTANCE (R-VALUE) OF NOT LESS THAN R-3.
 - HOT WATER PIPING THAT IS PART OF THE FINAL PIPE RUN TO THE PLUMBING FIXTURE AND IS NOT PART OF THE HEATED-WATER CIRCULATION SYSTEM CIRCULATION PATH IS NOT REQUIRED TO MEET THE MINIMUM INSULATION REQUIREMENTS OF C404.6.
 - PER 2021 UPC SECTION 312.6 NO WATER, SOIL, OR WASTE PIPE SHALL BE INSTALLED OR PERMITTED OUTSIDE OF A BUILDING, IN ATTICS OR CRAWL SPACES, OR IN AN EXTERIOR WALL UNLESS, WHERE NECESSARY, ADEQUATE PROVISION IS MADE TO PROTECT SUCH PIPE FROM FREEZING. ALL HOT AND COLD WATER PIPES OUTSIDE THE CONDITIONED SPACE SHALL BE PROVIDED WITH INSULATION WITH A MINIMUM R-VALUE OF R-3.
 - HEAT TRACING SHALL BE PROVIDED FOR COLD WATER AND IRRIGATION WATER IN UNCONDITIONED SPACES. CONTACT ENGINEERING IF NECESSARY. PER 2021 WSEC SECTION C403.12.3 FREEZE PROTECTION SYSTEMS, SUCH AS HEAT TRACING OF OUTDOOR PIPING, SHALL INCLUDE AUTOMATIC CONTROLS CONFIGURED TO SHUT OFF THE SYSTEMS WHEN OUTDOOR AIR TEMPERATURES ARE ABOVE 40°F.
 - PER 2021 WSEC TABLE C403.2.9 INSULATION FOR HOT WATER AND HOT WATER RECIRCULATION SHALL HAVE A THERMAL CONDUCTIVITY OF 0.21-0.28 (BTU·IN/H·FT²·°F) AT OPERATING TEMPERATURE.
 - INSULATION R-VALUE SHALL MEET THE MINIMUM REQUIREMENT. THICKNESS IS BASED ON GRAINGER SAMPLE DATA FOR K-FLEX(PVC/NBR) AND OWENS CORNING(FIBER GLASS).
 - ALL ADA P-TRAPS, HOT WATER SUPPLY TUBING, AND SHUT-OFF COCKS SHALL BE PROTECTED WITH APPROVED COVERS TO PREVENT SCALDING.
 - REQUIRED BY ENGINEERING BASED ON BEST PRACTICE.
 - INSULATION IS NOT REQUIRED ON PLASTIC COLD WATER PIPING.

WASHINGTON STATE-COMMERCIAL ENERGY CODE EFFICIENT HEATED WATER SUPPLY PIPING

NOMINAL PIPE SIZE (IN)	METHOD #1 - PIPE LENGTH (RECOMMENDED)		METHOD #2 - PIPE VOLUME			NOTES
	MAXIMUM ALLOWABLE PIPING LENGTH (FT)		PIPE VOLUME (FLUID OZ / FEET)	MAXIMUM ALLOWABLE PIPING LENGTH (FT)		
	PUBLIC LAVATORY FAUCET	OTHER FIXTURES		PUBLIC LAVATORY FAUCET	OTHER FIXTURES	
3/8	3	50	0.75	2.67	85	1-8
1/2	2	43	1.5	1.33	43	
5/8	1	32	2	1.00	32	
3/4	0.5	21	3	0.67	21	
7/8	0.5	16	4	0.50	16	
1	0.5	13	5	0.40	13	
1-1/4	0.5	8	8	0.25	8	
1-1/2	0.5	6	11	0.18	6	
2 OR LARGER	0.5	4	18	0.11	4	

- NOTES:**
- CONTRACTOR MAY USE METHOD 1 OR 2 TO DETERMINE MAXIMUM ALLOWABLE PIPING LENGTH FROM SOURCE OF HEATED WATER.
 - PER 2021 WSEC SECTION C404.3 WATER HEATER, CIRCULATING WATER SYSTEM & HEAT TRACE TEMPERATURE MAINTENANCE SHALL BE CONSIDERED SOURCE OF HEATED WATER.
 - THIS TABLE IS BASED ON MINIMUM CODE REQUIREMENTS. CONTRACTOR SHALL FOLLOW OWNERSHIP/DEVELOPER REQUIREMENT AND/OR BRAND STANDARD REGARDING MAXIMUM WAITING TIME FOR HOT WATER DELIVERY [OR ALLOWABLE NON-CIRCULATING HOT WATER PIPING LENGTH] AS LONG AS IT IS STRICTER THAN CODE MINIMUM. CONTACT ENGINEERING AS NECESSARY.
 - PIPE LENGTH METHOD ONLY: WHERE THE PIPING CONTAINS MORE THAN ONE SIZE OF PIPE, THE LARGEST SIZE OF PIPE SHALL BE USED FOR DETERMINING THE MAXIMUM ALLOWABLE LENGTH OF PIPING.
 - PIPE LENGTH METHOD ONLY: PER WSEC TABLE C404.3.1
 - PIPE VOLUME METHOD ONLY: PER WSEC SECTION C404.3.2 THE VOLUME FROM HEATED WATER TO THE TERMINATION OF FIXTURE SUPPLY PIPE SHALL NOT EXCEED 2 FLUID OUNCES FOR PUBLIC LAVATORIES AND 0.5 GALLON (64 FLUID OUNCES) FOR OTHER FIXTURES.
 - PIPE VOLUME METHOD ONLY: PER C404.3.2.1 WATER VOLUME SHALL BE THE SUM OF INTERNAL VOLUMES OF PIPE, VALVES, METERS AND MANIFOLD BETWEEN THE NEAREST SOURCE OF HEATED WATER AND TERMINATION OF THE FIXTURE SUPPLY PIPE. PROVIDED CALCULATION DOES NOT INCLUDE VALVES, METERS, MANIFOLDS.
 - REFER TO MANUFACTURER RECOMMENDATIONS AND PLUMBING FIXTURE SCHEDULE IN COMPLIANCE WITH 2021 UPC SECTION A106 AND TABLES 610.3 & A103.1 FOR MINIMUM BRANCH PIPE SIZES.

PIPING SUPPORTS (SUPPLY)

ALL SUSPENDED WATER SUPPLY PIPE SHALL BE SUPPORTED AS FOLLOWS PER 2021 UPC TABLE 313.3:

	MAX. HORIZONTAL SPACING	MAX. VERTICAL SPACING
COPPER PIPE <1 1/2"	6 FT.	10 FT.
COPPER PIPE >2"	10 FT.	10 FT.
COPPER TUBING <1 1/2"	6 FT.	10 FT.
COPPER TUBING >2"	10 FT.	10 FT.
CPVC < 1"	3 FT.	10 FT.
CPVC > 1 1/4"	4 FT.	10 FT.

PIPING SUPPORTS (WASTE)

ALL SUSPENDED SANITARY AND VENT PIPE SHALL BE SUPPORTED AS FOLLOWS PER 2021UPC TABLE 313.3:

	MAX. HORIZ. SPACING	MAX. VERT. SPACING
ABS	4 FT.	10 FT.
PVC (TYPE DWV)	4 FT.	10 FT.
CAST-IRON (<10 FT PIPE SECTIONS)	5 FT.	15 FT.
CAST-IRON (10 FT PIPE SECTIONS)	10 FT.	15 FT.

PRE-CONSTRUCTION MEETING NOTES

CONTRACTORS SHALL ATTEND A PRE-CONSTRUCTION MEETING WITH THE ENGINEER FOR THE PURPOSE OF REVIEWING THE WORK PRIOR TO ORDERING ANY EQUIPMENT OR PERFORMING ANY WORK. THE MEETING SHALL BE LOCATED AT THE PROJECT SITE ON A DATE AND TIME TO BE MUTUALLY AGREED. THE MEETING WILL BE A WORKING SESSION. THE MEETING WILL BE FACILITATED BY THE ENGINEER AND THE AGENDA WILL INCLUDE A DETAILED REVIEW OF THE PLANS AND SPECIFICATIONS, CROSS CHECK WITH OTHER TRADES FOR COORDINATION ISSUES, REVIEW OF PROPOSED PRODUCTS, REVIEW OF PLANNED MEANS AND METHODS, AND ON-SITE INVESTIGATION OF FIELD CONDITIONS RELATIVE TO EXISTING CONDITIONS THAT COULD AFFECT THE WORK. PERSONS ATTENDING THE MEETING SHALL BE KNOWLEDGEABLE OF THE PROJECT AND SHALL BE THE SPECIFIC PERSONS INTENDED TO CONTINUE WITH THE PROJECT THROUGH TO COMPLETION. IF REQUIRED, REVISED PLANS WILL BE ISSUED THROUGH OFFICIAL CHANNELS. CHANGES IN THE BID PRICE WILL BE DISCUSSED, BUT NO CHANGE ORDERS WILL BE ISSUED UNLESS PROCESSED THROUGH OFFICIAL CHANNELS. IT SHALL BE UNDERSTOOD THAT THE ENGINEER HAS NO AUTHORITY TO ISSUE CHANGE ORDERS.

THE FOLLOWING TRADES SHALL BE REPRESENTED FOR THE MINIMUM TIME INDICATED:

MECHANICAL SHEET METAL	4 HOURS
PLUMBING/PIPING	4 HOURS
ELECTRICAL	4 HOURS
SPRINKLER	2 HOURS
GENERAL CONTRACTOR	ALL SESSIONS

PLUMBING NOTES

PRGA20250487

- CONNECTIONS: PROVIDE PLUMBING FIXTURE CONNECTIONS TO BUILDING WASTE, VENT, COLD WATER, AND HOT WATER SYSTEM IN ACCORDANCE WITH DRAWINGS, MANUFACTURER'S RECOMMENDATIONS, AND LOCAL CODES. CONNECT TO EACH FIXTURE, EQUIPMENT, ETC. WITH ALL ACCESSORIES, VALVES, VACUUM BREAKERS, REGULATORS, UNIONS, ETC. AS REQUIRED AND AS RECOMMENDED BY THE MANUFACTURERS. REFER TO PLUMBING FIXTURE CONNECTION SCHEDULE ON PLANS.
- HOT AND COLD: WATER PIPING CONNECTION TO EACH FIXTURE SHALL BE COLD WATER ON THE RIGHT HAND SIDE AND HOT WATER ON THE LEFT HAND SIDE.
- HOT WATER: NON-CIRCULATING HOT WATER PIPE SHALL NOT EXCEED 10' UNLESS OTHERWISE SHOWN ON DRAWINGS.
- VENT STACKS: COORDINATE VENT STACK WITH HVAC EQUIPMENT TO MAINTAIN MINIMUM 10' CLEARANCE FROM OUTSIDE AIR INTAKES.
- CLEANOUTS: PROVIDE CLEANOUTS PER CURRENT UPC AND AS REQUIRED BY LOCAL JURISDICTIONS. CLEANOUTS SHALL BE LOCATED IN WALLS/FLOORS WHERE THEY ARE NOT HIGHLY VISIBLE. FLOOR CLEANOUTS IN CARPETED AREAS TO BE FITTED WITH CARPET INSERTS. LOCATIONS SHALL BE SUBMITTED TO ARCHITECT FOR APPROVAL. NOTE: NOT ALL CLEANOUTS ARE SHOWN ON THE PLUMBING DRAWINGS.
- SUDS RELIEF: PROVIDE SUDS RELIEF IN ACCORDANCE WITH 2021 UPC SECTION 711.0, STATE AND LOCAL CODES.
- SHUT-OFFS: PROVIDE 1/4 TURN BALL VALVE ANGLE STOP SHUT-OFF VALVES AND BRAIDED STAINLESS STEEL FLEX CONNECTORS AT HOT AND COLD WATER SUPPLY TO EACH FIXTURE. EXCEPTION: PROVIDE SCREWDRIVER STOPS AT BATH/SHOWERS.
- TUB SPOUTS SHALL BE THREADED (NO PUSH-ON FITTINGS).
- TRAP ARMS: PROVIDE TRAP ARMS SUCH THAT THE MAXIMUM LENGTH WILL NOT EXCEED CODE REQUIREMENTS.
- ADA INSULATION: AT PLUMBING PIPING EXPOSED UNDER LAVATORIES, INSULATE THE EXPOSED PIPING AND TRAPS WITH PRODUCT SPECIFICALLY DESIGNED FOR THIS APPLICATION MEETING ADA REQUIREMENTS. PROVIDE HANDI-LAV GUARD OR EQUIVALENT. OFFSET P-TRAPS TO CLEAR WHEELCHAIR ACCESS.
- GAS EQUIPMENT: GAS EQUIPMENT SHALL BE INSTALLED PER EQUIPMENT LISTINGS, APPLICABLE IFGC, UPC, LOCAL CODES & NFPA STANDARDS.
- GAS CONNECTIONS: INSTALL FLEXIBLE QUICK DISCONNECT ASSEMBLIES FOR ALL GAS FIRED KITCHEN EQUIPMENT PER APPLICABLE IFGC, UPC, LOCAL CODES & NFPA STANDARDS. PROVIDE LOCKABLE GAS SHUT-OFF VALVES FOR FIREPLACES & BBQS IN UNATTENDED PUBLIC LOCATIONS IN THE BUILDING.
- WATER HAMMER ARRESTORS: PROVIDE AT THE END OF HOT AND COLD WATER LINES SERVING TWO OR MORE FIXTURES; SIZE IN ACCORDANCE WITH PLUMBING AND DRAINAGE INSTITUTE (PDI) REQUIREMENTS. WATER HAMMER ARRESTORS ARE REQUIRED FOR QUICK CLOSING VALVES, SUCH AS LAUNDRY WASHERS, FLUSH VALVES (PUBLIC TOILETS), ETC.
- TRAP PRIMERS AS SPECIFIED: PROVIDE TRAP PRIMERS AND PIPING FOR FLOOR DRAINS, FLOOR SINKS, AREA DRAINS & HUB DRAINS. ARRANGE PIPING TO ACHIEVE EQUAL FLOW TO EACH DRAIN AND FLOOR SINK FOR TRAP PRIMERS SERVING MULTIPLE DRAINS AND FLOOR SINKS. COORDINATE EXACT LOCATIONS WITH ARCHITECT & ELECTRICAL ENGINEER.
- P-TRAPS: ALL EXPOSED P-TRAPS SHALL BE CHROME-PLATED BRASS. P-TRAPS SERVING HANDICAPPED COUNTER TOP LAVATORIES SHALL BE INSULATED.
- THROUGHOUT THE PROJECT PROVIDE BALL VALVES. GATE VALVES SHALL NOT BE USED. NO EXCEPTIONS.
- HOT WATER RECIRCULATING BALANCING VALVES SHOULD BE BELL & GOSSETT CIRCUIT SETTER (WATTS OR EQUAL) WITH INTEGRAL READOUT PORTS, ADJUSTMENT KNOB, DRAIN CONNECTION, AND POSITIVE SHUTOFF.
- DISASSEMBLY PROVISIONS: PROVIDE UNIONS OR FLANGES AT PIPING CONNECTIONS TO EQUIPMENT, COILS, TRAPS, CONTROL VALVES, AND OTHER COMPONENTS TO ALLOW DISASSEMBLY FOR MAINTENANCE.
- REDUCERS: PROVIDE AS REQUIRED FROM LINE PIPE SIZE TO EQUIPMENT, TRAP, COIL, AND CONTROL VALVE CONNECTION SIZES.
- VALVE TAGS: PROVIDE VALVE TAGS PER SPECIFICATIONS TO IDENTIFY VALVE AND THE AREA IT SERVES.
- OFFSETS: PROVIDE FOR BRANCH LINES TO EQUIPMENT.
- ALL TEMPERATURE MIXING VALVES SHALL COMPLY WITH ASSE-1070 SAFETY STANDARDS.
- PROVIDE PIPE MARKER WITH DIRECTION OF FLOW. LABEL "NON-POTABLE WATER DO NOT DRINK" CLEARLY ON NON-POTABLE WATER PIPING.
- PROVIDE EXPANSION LOOPS/EXPANSION JOINTS IN PIPING PER 2021 UPC TABLE 313.3 AND MANUFACTURER INSTALLATION INSTRUCTIONS.
- PROVIDE APPROVED PIPE HANGERS & PIPE SUPPORTS IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS AND 2021 UPC TABLES 313.3 & 313.6. SUBMIT FOR APPROVAL.
- DIELECTRIC UNIONS: PROVIDE AT CONNECTIONS OF DISSIMILAR PIPE.
- REFRIGERANT PIPING: PROVIDE SIZING & INSTALLATION IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
- CONDENSATE DRAIN: PROVIDE A P-TRAP FOR EACH HVAC UNIT CONDENSATE PAN WITH PLUG TEES FOR CLEANING. CONDENSATE DRAINS SHALL BE DISCHARGED TO AN INDIRECT WASTE OR OUTSIDE.
- PROVIDE VIBRATION, SEISMIC ISOLATIONS & CONTROLS IN ACCORDANCE WITH SPEC SECTION 230548.
- PIPING & EQUIPMENT SUPPORTS/HANGERS & SEISMIC RESTRAINTS TO BE DESIGNED BY DESIGN BUILT CONTRACTOR.
- IF NEEDED, PROVIDE VACUUM BREAKERS AT ALL HOSE BIBBS.
- FLOOR DRAINS OR SIMILAR TRAPS DIRECTLY CONNECTED TO THE DRAINAGE AND SUBJECT TO INFREQUENT USE SHALL BE PROVIDED WITH AN APPROVED AUTOMATIC MEANS OF MAINTAINING THEIR WATER SEALS IN ACCORDANCE WITH 2021 UPC 1007.0.
- INSULATION MATERIAL SHALL MEET CITY OF PUYALLUP QUALITY STANDARDS.
- ALL PIPING AND DUCTWORK SHALL BE INSULATED CONSISTENT WITH THE 2021 WASHINGTON STATE ENERGY CODE.
- BUILDING DRAIN AND VENT PIPING MATERIALS SHALL COMPLY WITH 2021 UPC 701.0 AND 903.0.
- ALL SANITARY SYSTEM MATERIAL SHALL BE LISTED BY AN APPROVED LISTING AGENCY.
- ALL STORAGE WATER HEATING EQUIPMENT SHALL BE PROVIDED WITH AN APPROVED, LISTED EXPANSION TANK OR OTHER DEVICE DESIGNED FOR INTERMITTENT OPERATION FOR THERMAL EXPANSION CONTROL PER 2021 UPC 608.3.
- WATER HEATERS SHALL BE ANCHORED OR STRAPPED TO RESIST HORIZONTAL DISPLACEMENTS DUE TO SEISMIC MOTION PER 2021 UPC 507.2.
- MATERIAL EXPOSED WITHIN A DUCT OR PLENUM SHALL COMPLY WITH 2021 IMC 602.2.1.
- HVAC EQUIPMENT AND WATER HEATERS SHALL COMPLY WITH 2021 IMC CHAPTER 3.
- BOILERS SHALL COMPLY WITH ALL THE REQUIREMENTS OF 2021 IMC CHAPTER 10.
- PROVIDE EXPANSION TANKS FOR BOILERS PER 2021 IMC SECTION 1009.0.
- SHOWERS AND TUB/SHOWER COMBINATIONS SHALL BE PROVIDED WITH MIXING VALVES PER 2021 UPC 408.0.
- PLUMBING FIXTURES AND FITTINGS SHALL COMPLY WITH CITY OF PUYALLUP WATER CONSERVATION STANDARDS.
- CONTRACTOR SHALL PROVIDE FIRESTOPPING AT PENETRATIONS AS NECESSARY TO RETAIN THE FIRE RATING OF ALL ASSEMBLIES. ALL WORK SHALL BE IN COMPLIANCE WITH CODE REQUIREMENTS FOR THE BUILDING CONSTRUCTION TYPE.
- ALL GARAGE DRAINS, TRASH ROOMS DRAINS & GARAGE TRENCH DRAINS SHALL BE TAKEN TO SAND/OIL INTERCEPTOR(S) BEFORE CONNECTING TO THE SANITARY SEWER SYSTEM.
- PLUMBING CONTRACTOR SHALL PROVIDE REDUCED PRESSURE BACKFLOW PREVENTERS OR OTHER APPROVED BACKFLOW PREVENTION DEVICE WHERE REQUIRED BY HEALTH AUTHORITIES, FOOD SERVICE DRAWINGS, APPLIANCE MANUFACTURER INSTRUCTIONS AND BY CODE.

- PROVIDE REQUIRED & PROPER BACK FLOW PREVENTERS AS SPECIFIED FOR THE APPLIANCES INCLUDING, BUT NOT LIMITED TO THE FOLLOWING:
- ICE MACHINES AND ICE MAKERS
 - CARBONATED BEVERAGE DISPENSING SYSTEMS
 - COFFEE BREWERS
 - ESPRESSO MACHINES
 - WATER FILTERS
 - STEAM OR HOT WATER BOILERS
 - IRRIGATION SYSTEM
 - FIRE PROTECTION SYSTEM
 - CHEMICAL TREATMENT SYSTEM
 - SOAP/CHEMICAL DISPENSER SYSTEM
 - COMMERCIAL WASHER

APPLICABLE CODES

THE FOLLOWING PROJECT DESIGN IS BASED ON THE FOLLOWING CODES:

- 2018 INTERNATIONAL BUILDING CODE (IBC) & WASHINGTON STATE AMENDMENTS
- 2018 INTERNATIONAL MECHANICAL CODE (IMC) & WASHINGTON STATE AMENDMENTS
- 2018 UNIFORM PLUMBING CODE (UPC) & WASHINGTON STATE AMENDMENTS
- 2018 WASHINGTON STATE ENERGY CONSERVATION CODE (WSEC)
- 2018 INTERNATIONAL FUEL GAS CODE (IFGC) & WASHINGTON STATE AMENDMENTS

CONTRACTOR SUBSTITUTIONS & REVISIONS

PLEASE SUBMIT PROPOSALS FOR SUBSTITUTIONS OR REVISIONS FOR REVIEW AND APPROVAL PRIOR TO ORDERING MATERIAL OR DOING WORK. FOR EQUIPMENT THAT IS SCHEDULED BY MANUFACTURER'S NAME AND CATALOG DESIGNATIONS, THE MANUFACTURER'S PUBLISHED DATA AND/OR SPECIFICATION FOR THAT ITEM ARE CONSIDERED PART OF SPECIFICATION. ENGINEERING COSTS FOR REVISING MEP PLANS SHALL BE ADDRESSED IN THE COST ANALYSIS OF THE SUBSTITUTION PROPOSAL. CONTRACTOR TO COORDINATE WITH ENGINEER AND DETERMINE ASSOCIATED DESIGN AND PERMITTING COSTS. CONTRACTOR SHALL BE RESPONSIBLE FOR OTHER COSTS ASSOCIATED WITH UNFORESEEN ISSUES RESULTING FROM SUBSTITUTIONS OR REVISIONS.

REVISIONS	DESCRIPTION	DATE	PERMIT RESUBMITTAL #2
NO.	1	8/29	



JMN	JMN	JMN	JMN
DRAWN:	DESIGNED:	CHECKED:	APPROVED:

EAST TOWN CROSSING - BUILDING A
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

ROBISON ENGINEERING, INC
19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 2069364343

DATE:
8-29-2025

SHEET TITLE:
PLUMBING NOTES, TABLES AND CODES

SHEET NO.
P0.01

WATER SUPPLY PIPE SIZING TABLES

SUPPLY PIPE SIZING SCHEDULE - CPVC											
PIPE SIZE	COLD WATER, FLUSH TANK			COLD WATER, FLUSH VALVE			HOT WATER			FRICTION LOSS FACTOR: 12.0 PSI/100 FT	
	FIXTURE UNITS	FLOW, GPM	VELOCITY, FPS	FIXTURE UNITS	FLOW, GPM	VELOCITY, FPS	FIXTURE UNITS	FLOW, GPM	VELOCITY, FPS	FLOW, GPM	VELOCITY, FPS
1/2"	3.6	3.60	5.00	---	---	---	3.6	3.60	5.00	1.50	2.00
3/4"	7.7	6.70	5.00	---	---	---	7.7	6.70	5.00	2.70	2.00
1"	15.2	11.20	5.00	---	---	---	15.2	11.20	5.00	4.50	2.00
1-1/4"	30.0	20.00	5.00	---	---	---	30.0	20.00	5.00	8.00	2.00
1-1/2"	46.3	27.50	5.00	10.5	27.50	5.00	46.3	27.50	5.00	11.00	2.00
2"	108.1	46.00	5.00	38.4	46.00	5.00	108.1	46.00	5.00	18.40	2.00
2-1/2"	205.3	66.10	5.00	93.5	66.10	5.00	205.3	66.10	5.00	26.40	2.00
3"	389.7	102.90	5.00	264.7	102.90	5.00	389.7	102.90	5.00	41.20	2.00
4"	807.3	179.20	5.00	779.8	179.20	5.00	807.3	179.20	5.00	71.70	2.00
6"	2738.5	406.20	5.00	2738.5	406.20	5.00	2738.5	406.20	5.00	162.50	2.00

SUPPLY PIPE SIZING SCHEDULE - PEX											
PIPE SIZE	COLD WATER, FLUSH TANK			COLD WATER, FLUSH VALVE			HOT WATER			FRICTION LOSS FACTOR: 12.00 PSI/100 FT	
	FIXTURE UNITS	FLOW, GPM	VELOCITY, FPS	FIXTURE UNITS	FLOW, GPM	VELOCITY, FPS	FIXTURE UNITS	FLOW, GPM	VELOCITY, FPS	FLOW, GPM	VELOCITY, FPS
1/2"	1.7	2.7	4.9	---	2.7	4.9	3.1	3.1	5.6	1.10	2.00
3/4"	7.9	6.9	6.2	---	6.9	6.2	9.8	7.9	7.2	2.20	2.00
1"	19.1	13.5	7.4	---	13.5	7.4	20.9	14.6	8.0	3.64	2.00
1-1/4"	36.5	23.3	8.6	6.3	23.3	8.6	33.5	21.8	8.0	5.44	2.00
1-1/2"	71.1	36.3	9.6	22.2	36.3	9.6	53.3	30.3	8.0	7.58	2.00
2"	199.8	65.0	10.0	89.9	65.0	10.0	134.8	52.0	8.0	12.99	2.00
2-1/2"	369.5	98.9	10.0	246.9	98.9	10.0	270.6	79.1	8.0	19.80	2.00
3"	588.9	141.0	10.0	507.2	141.0	10.0	439.0	112.8	8.0	28.16	2.00

WATER SUPPLY PRESSURE CALCULATIONS

SIZING IS PER 2021 UPC APPENDIX A

WATER SUPPLY PIPE SIZING CALCULATION FORM

UTILITY SUPPLY WATER PRESSURE: **55** PSI STATIC PRESSURE
ASSUMING BUILDING PRESSURE

BOOSTER PUMP: **70** PSI
OUTLET PRESSURE

WATER SOFTENER LOSS: **0** PSI
TYPICALLY 5-20 PSI, IF NO SOFTENER ENTER "0".

STATIC LIFT: **30** FEET = **13.0** PSI

THERMOSTATIC MIXING VALVE LOSS: **0** PSI

REQUIRED MINIMUM PRESSURE AT FURTHEST PLUMBING FIXTURE: **25** PSI

PRESSURE AVAILABLE TO OFFSET FRICTION LOSSES: **32.0** PSI

PIPING SYSTEM LENGTH FROM SERVICE TO FURTHEST FIXTURE: **200** FEET
 FITTING ALLOWANCE: **66.6667** FEET

MAXIMUM FRICTION LOSS FACTOR: **12.0** PSI/100 FT

SELECTED FRICTION LOSS FACTOR: **12.0** PSI/100 FT
MAX CW VELOCITY 8 FPS. MAX HW VELOCITY 5 FPS.

SUPPLY PIPE SIZING SCHEDULE							Copper Type:		Type L
FLUSH TANK CW			HOT WATER				FLUSH VALVE CW		
PIPE SIZE	FLOW, GPM	VEL. FPS	FIXTURE UNITS	FLOW, GPM	VEL. FPS	FIXTURE UNITS	FLOW, GPM	VEL. FPS	FIXTURE UNITS
2-1/2"	116.0	8.0	440.0	72.0	5.0	215.0	116.0	8.0	340.0
3"	160.0	8.0	750.0	100.0	5.0	350.0	160.0	8.0	680.0
4"	280.0	8.0	1600.0	175.0	5.0	800.0	280.0	8.0	1600.0
6"	650.0	8.0	5250.0	400.0	5.0	2750.0	650.0	8.0	5250.0

PLUMBING EQUIPMENT SCHEDULES

City of Puyallup
 Development & Permitting Services
 ISSUED PERMIT
 PRGA20250487

Building Permit
 Engineering
 Planning
 Public Works
 Fire
 Traffic

PIPE MATERIALS			
PIPE TYPE	MATERIAL	JOINT	NOTES
UNDERGROUND WATER SERVICE ENTRANCE PIPING	PVC	SOLVENT CEMENT	
WATER DISTRIBUTION PIPING – MAINS ADN RISERS	SCHEDULE 80 CPVC	SOLVENT CEMENT	
WATER DISTRIBUTION PIPING – UNIT FIXTURE RUN-OUTS	PEX	EXPANSION FITTINGS	3
WASTE & VENT PIPING	SCHEDULE 40 SOLID CORE PVC OR ABS	SOLVENT CEMENT	4
STORM PIPING	SCHEDULE 40 SOLID CORE PVC OR ABS	SOLVENT CEMENT	
CONDENSATE DRAIN PIPING	CPVC OR PEX	SOLVENT CEMENT OR EXPANSION FITTINGS	

- NOTES:
- ALL SANITARY SYSTEM MATERIALS SHALL BE LISTED BY AN APPROVED LISTING AGENCY.
 - NOT USED
 - PROVIDE THERMAL EXPANSION LOOPS FOR ALL CPVC PIPING PER MANUFACTURER REQUIREMENTS.
 - NOT TO BE USED WHERE EXPOSED IN RETURN AIR PLENUM (METAL PIPING REQUIRED IN RETURN AIR PLENUMS.) USE CAST IRON FOR PIPING IN PLENUM.

HYBRID WATER HEATER SCHEDULE							
EQUIP NO.	SERVICE	STORAGE, GALLONS	STORAGE TEMP °F	ELECTRICAL		UNIFORM ENERGY FACTOR	BASIS OF DESIGN (1)(2)
				VOLTAGE	MOCPP		
HPWH-1	PER PLANS	50	120	208V/1P	30	3.80	A.O.SMITH HPTS-50

- NOTES:(1) INSTALL IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION REQUIREMENTS.
 (2) PER WSEC R406, ENERGY CREDIT OPTION 5.5, HEAT PUMP WATER HEATER MUST THE STANDARDS FOR TIER III OF NEEA'S ADVANCED WATER HEATER SPECIFICATION.


EXPANSION TANK								
EQUIP. TAG	LOCATION	SERVICE	CAPACITY GAL.	TANK SIZE, IN		OPERATING WEIGHT, LBS	BASIS OF DESIGN	NOTES
				DIAMETER	HEIGHT			
ET-1	APARTMENT	DOMESTIC HOT WATER (EA. UNIT)	2	8	13	25	AMTROL ST-5	1,2

- NOTES:
- INSTALL ACCORDING TO MANUFACTURER'S REQUIREMENTS
 - EXPANSION TANK PRE-CHARGE PRESSURE SHALL BE SET TO INLET WATER STATIC PRESSURE AT INSTALLATION.

PACKAGED BOOSTER PUMP SCHEDULE									
EQUIP NO.	SERVICE	TYPE	TOTAL FLOW, GPM	PRESSURE RISE (INLET/OUTLET) PSIG	MOTOR HP (EACH)	ELECTRICAL	FLA (AMPS)	WEIGHT, LBS	BASIS OF DESIGN
BP-1	DOMESTIC WATER	SIMPLEX	61.5	30 (40/70)	2	220V/1P	9.1A	47.7	GRUNDFOS CMBE 10-54

- NOTES: (1) SINGLE POINT POWER CONNECTION.
 (2) PROVIDE ALL REQUIRED VALVES, PIPING, CONTROLS, ETC. FOR A COMPLETE SYSTEM.
 (3) PROVIDE VFD'S FOR EACH PUMP.
 (4) PROVIDE WITH FACTORY PROVIDED EXPANSION TANK.

REVISIONS	DESCRIPTION	DATE	PERMIT RESUBMITTAL #2
NO.	1	8/29	



DRAWN: JMN	DESIGNED: JMN	CHECKED: JMN	APPROVED: JMN
------------	---------------	--------------	---------------

PROJECT: EAST TOWN CROSSING - BUILDING A
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA


19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-864-3343

ROBISON ENGINEERING, INC.

DATE: 8-29-2025

SHEET TITLE: PLUMBING EQUIPMENT SCHEDULES, PIPE SIZING TABLES AND PRESSURE CALCULATIONS

SHEET NO. P0.03

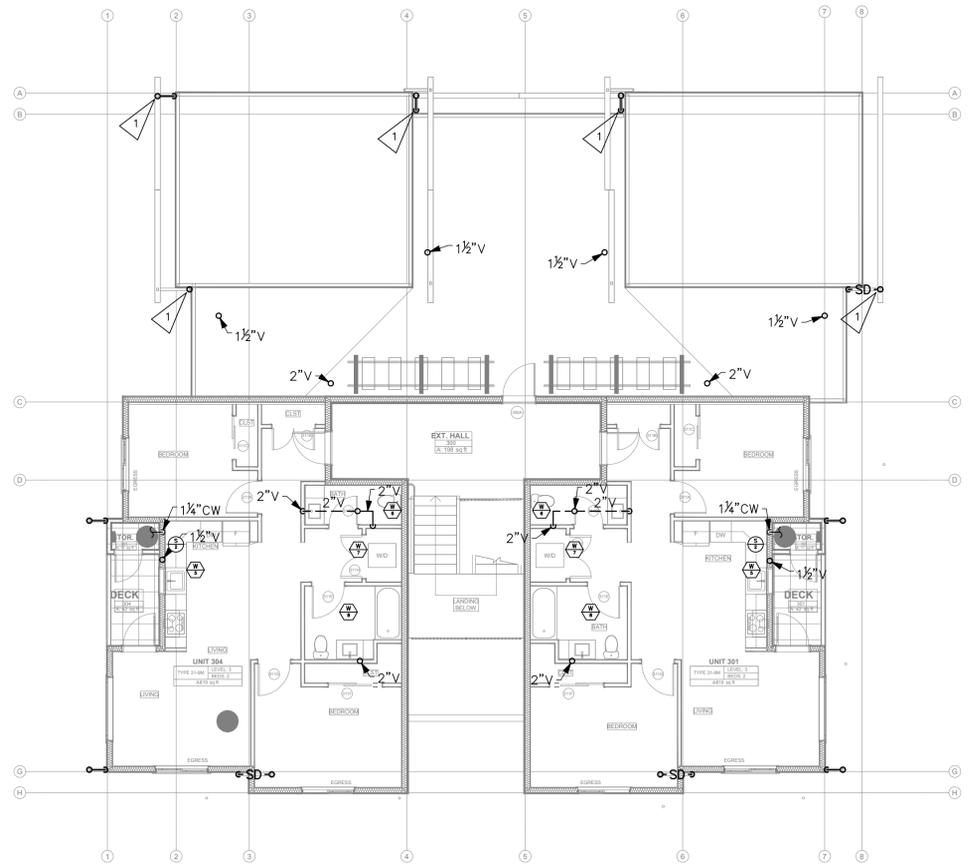

NOTES:

- STORM DRAIN SIZING: STORM DRAINAGE PIPING SIZED PER 2021 UPC CHAPTER 11, FOR 1" PER HOUR RAINFALL RATE, AT 1/8" PER FOOT SLOPE UNLESS NOTED OTHERWISE:
- WASTE & VENT SIZING: WASTE & VENT PIPING SIZED PER 2021 UPC CHAPTER 7, WASTE PIPING SHALL BE SLOPED AT 1/4" PER FOOT:
- PROVIDE TRAP PRIMERS FOR ALL FLOOR DRAINS. SEE DETAIL 2, P9.00.
- NOT ALL FIXTURE PIPING SHOWN HERE. SEE RISER DIAGRAMS AND ENLARGED PLANS FOR ADDITIONAL FIXTURE PIPING AND SUDS RELIEF REQUIREMENTS.
- CONDENSATE PIPE SIZING: CONDENSATE DRAINING PIPING SIZED PER 2021 UPC CHAPTER 8 TABLE 814.3. TERMINATE BATHROOM CONDENSATE WASTE VIA LAVATORY TAILPIECE. SEE DETAIL 6/P600 FOR DETAIL OF CONDENSATE TERMINATION.

PIPE SIZE	HORIZONTAL	VERTICAL
3"	3,288	8,800
4"	7,520	18,400
6"	21,400	34,600
8"	46,000	54,000
10"	82,800	82,800

PIPE SIZE	VERT.	HORIZ.	VENT
1 1/2"	2 DFU	1 DFU	8 DFU
2"	16 DFU	8 DFU	24 DFU
3"	48 DFU	35 DFU	84 DFU
4"	256 DFU	216 DFU	256 DFU
6"	1,380 DFU	720 DFU	1,380 DFU
8"	3,600 DFU	2,640 DFU	3,600 DFU

PIPE SIZE	EQUIPMENT CAPACITY (TONS)
3/4"	20
1"	40
1 1/4"	90
1 1/2"	125
2"	250

- CPVC AND PEX PIPE SIZING: COLD WATER BASED ON 10FT/S FOR SIZES UP TO 2" (PEX PIPING) AND 8FT/S FOR LARGER SIZES (CPVC) PER MANUFACTURERS RECOMMENDATION. HOT WATER BASED ON 8FT/S FOR SIZES UP TO 2" (PEX PIPING) AND 5FT/S FOR LARGER SIZES (CPVC) PER MANUFACTURERS RECOMMENDATION. SELECTED FRICTION LOSS FACTOR IS 12 PSI/100' PER CALCULATIONS ON P0.01. FIXTURE UNIT FLOW RATE CONVERSIONS ARE BASED ON 2021 UPC APPENIX A.

PIPE SIZE	COLD WSFU	HOT WSFU
1/2"	1	2
3/4"	7	8
1"	17	19
1 1/4"	33	33
1 1/2"	62	54
2"	199	134
2 1/2"	375	270
3"	589	443

BUILDING A LEVEL 3 – PLUMBING PLAN


SCALE: 1/8" = 1'-0"



NO.	DATE	DESCRIPTION	PERMIT RESUBMITTAL #2
1	8/29		



DRAWN:	DESIGNED:	CHECKED:	APPROVED:
JMN	JMN	JMN	JMN

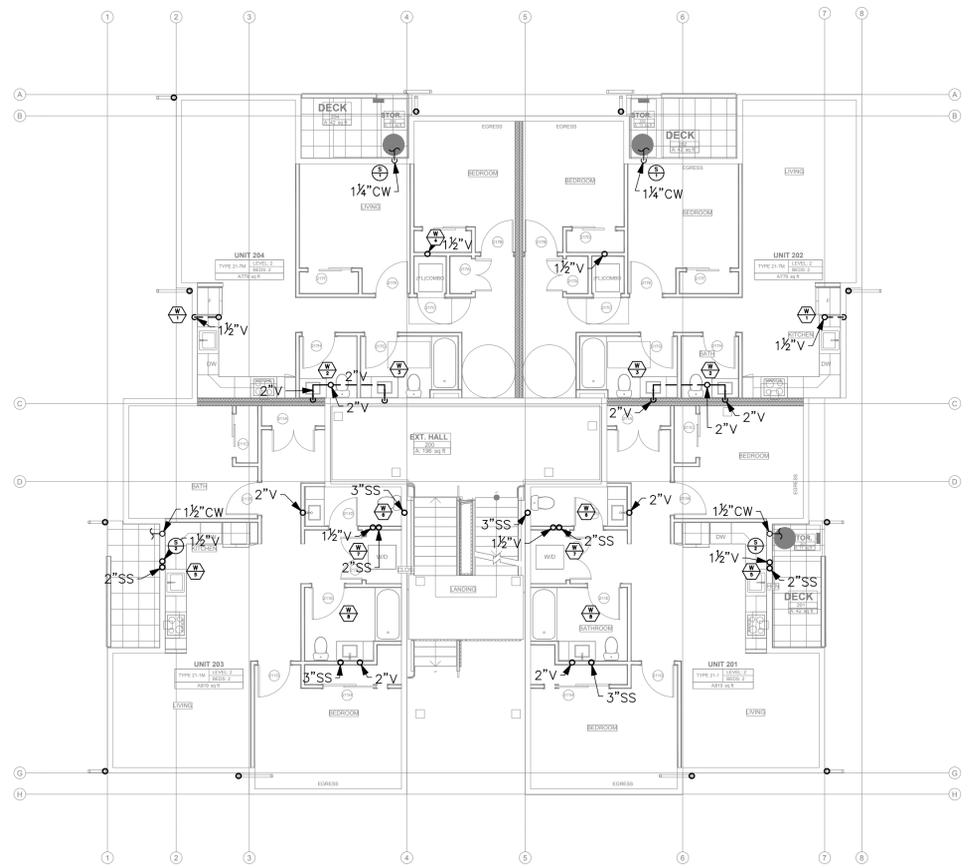

NOTES:

- STORM DRAIN SIZING: STORM DRAINAGE PIPING SIZED PER 2021 UPC CHAPTER 11, FOR 1" PER HOUR RAINFALL RATE, AT 1/8" PER FOOT SLOPE UNLESS NOTED OTHERWISE:
- WASTE & VENT SIZING: WASTE & VENT PIPING SIZED PER 2021 UPC CHAPTER 7, WASTE PIPING SHALL BE SLOPED AT 1/4" PER FOOT:
- PROVIDE TRAP PRIMERS FOR ALL FLOOR DRAINS. SEE DETAIL 2, P9.00.
- NOT ALL FIXTURE PIPING SHOWN HERE. SEE RISER DIAGRAMS AND ENLARGED PLANS FOR ADDITIONAL FIXTURE PIPING AND SUDS RELIEF REQUIREMENTS.
- CONDENSATE PIPE SIZING: CONDENSATE DRAINING PIPING SIZED PER 2021 UPC CHAPTER 8 TABLE 814.3. TERMINATE BATHROOM CONDENSATE WASTE VIA LAVATORY TAILPIECE. SEE DETAIL 6/P600 FOR DETAIL OF CONDENSATE TERMINATION.

PIPE SIZE	HORIZONTAL	VERTICAL
3"	3,288	8,800
4"	7,520	18,400
6"	21,400	34,600
8"	46,000	54,000
10"	82,800	82,800

PIPE SIZE	VERT.	HORIZ.	VENT
1 1/2"	2 DFU	1 DFU	8 DFU
2"	16 DFU	8 DFU	24 DFU
3"	48 DFU	35 DFU	84 DFU
4"	256 DFU	216 DFU	256 DFU
6"	1,380 DFU	720 DFU	1,380 DFU
8"	3,600 DFU	2,640 DFU	3,600 DFU

PIPE SIZE	EQUIPMENT CAPACITY (TONS)
3/4"	20
1"	40
1 1/4"	90
1 1/2"	125
2"	250

- CPVC AND PEX PIPE SIZING: COLD WATER BASED ON 10FT/S FOR SIZES UP TO 2" (PEX PIPING) AND 8FT/S FOR LARGER SIZES (CPVC) PER MANUFACTURERS RECOMMENDATION. HOT WATER BASED ON 8FT/S FOR SIZES UP TO 2" (PEX PIPING) AND 5FT/S FOR LARGER SIZES (CPVC) PER MANUFACTURERS RECOMMENDATION. SELECTED FRICTION LOSS FACTOR IS 12 PSI/100' PER CALCULATIONS ON P0.01. FIXTURE UNIT FLOW RATE CONVERSIONS ARE BASED ON 2021 UPC APPENIX A.

PIPE SIZE	COLD WSFU	HOT WSFU
1/2"	1	2
3/4"	7	8
1"	17	19
1 1/4"	33	33
1 1/2"	62	54
2"	199	134
2 1/2"	375	270
3"	589	443

BUILDING A LEVEL 2 – PLUMBING PLAN

SCALE: 1/8" = 1'-0"



PROJECT: EAST TOWN CROSSING - BUILDING A
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206-864-3343

ROBISON ENGINEERING, INC.

DATE:
8-29-2025


SHEET TITLE:
BUILDING A –
LEVEL 2 AND
LEVEL 3 PLUMBING
PLANS

SHEET NO.
P2A.1

NO.	DATE	DESCRIPTION
1	8/29	PERMIT RESUBMITTAL #2




JMN	JMN	JMN	JMN
DRAWN:	DESIGNED:	CHECKED:	APPROVED:

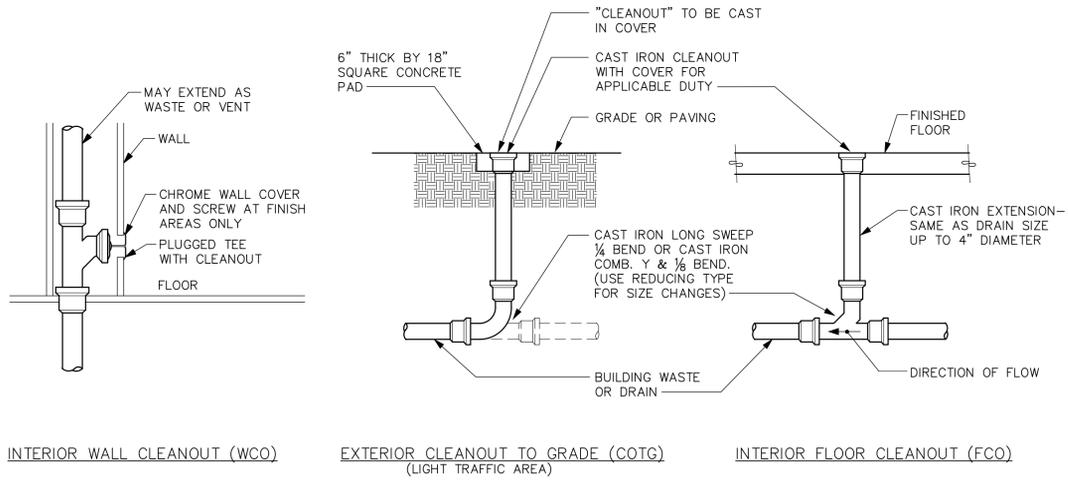


CLEANOUTS
 DETAIL
 SCALE: NONE

6
 P4.00

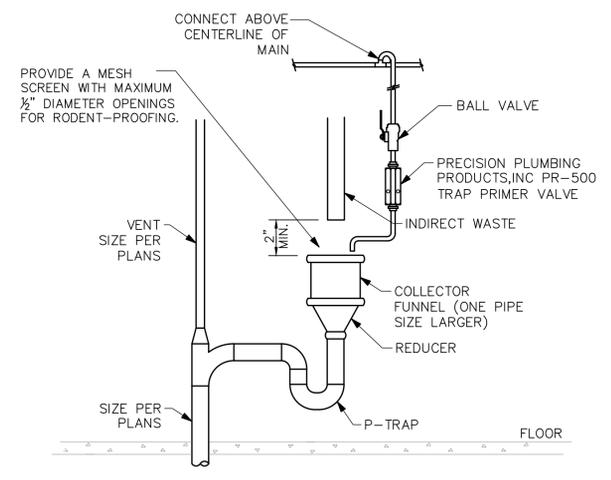


HUB DRAIN
 DETAIL
 SCALE: NONE

5
 P4.00

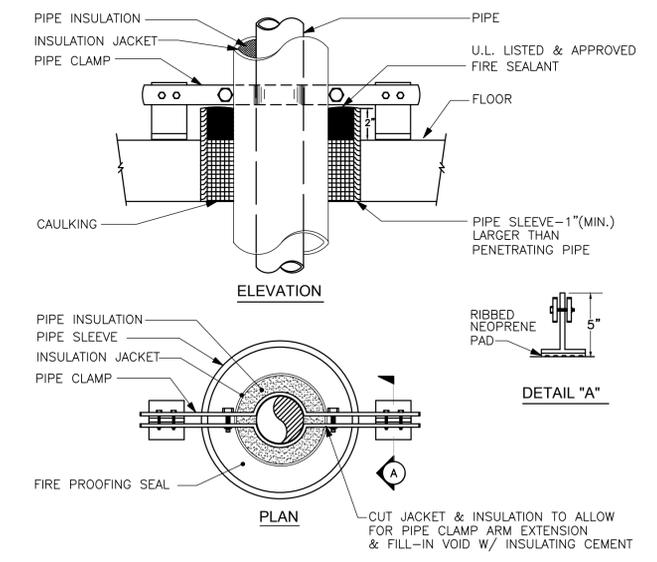


RISER PIPE SUPPORT
 DETAIL
 SCALE: NONE

4
 P4.00

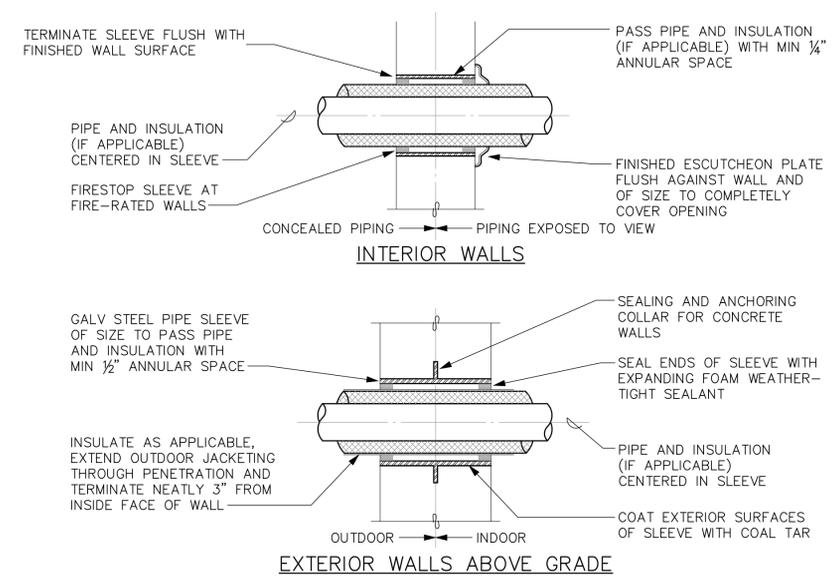


PIPE SLEEVES THROUGH WALLS
 DETAIL
 SCALE: NONE

3
 P4.00

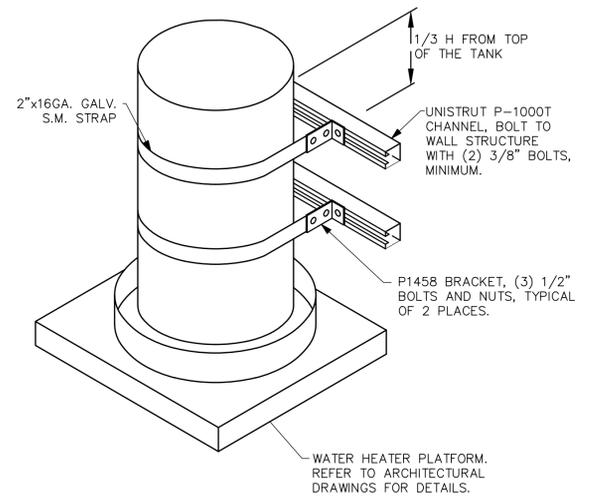

WATER HEATER SEISMIC STRAPPING
 DETAIL
 SCALE: NONE

2
 P4.00

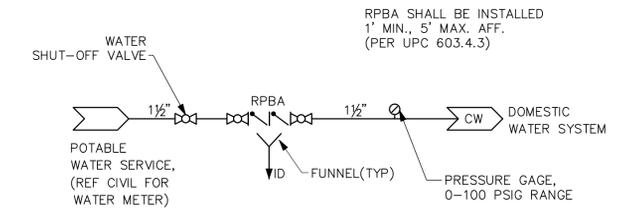

WATER SERVICE PIPING DIAGRAM
 SCALE: NONE

1
 P4.00

PROJECT: **EAST TOWN CROSSING - BUILDING A**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-864-3343

ROBISON ENGINEERING, INC.

DATE:
 8-29-2025


SHEET TITLE:
 DETAILS

SHEET NO.
P4A.0

NO.	DATE	DESCRIPTION	PERMIT RESUBMITTAL #2
1	8/29		




JMN	JMN	JMN	JMN
DRAWN:	DESIGNED:	CHECKED:	APPROVED:

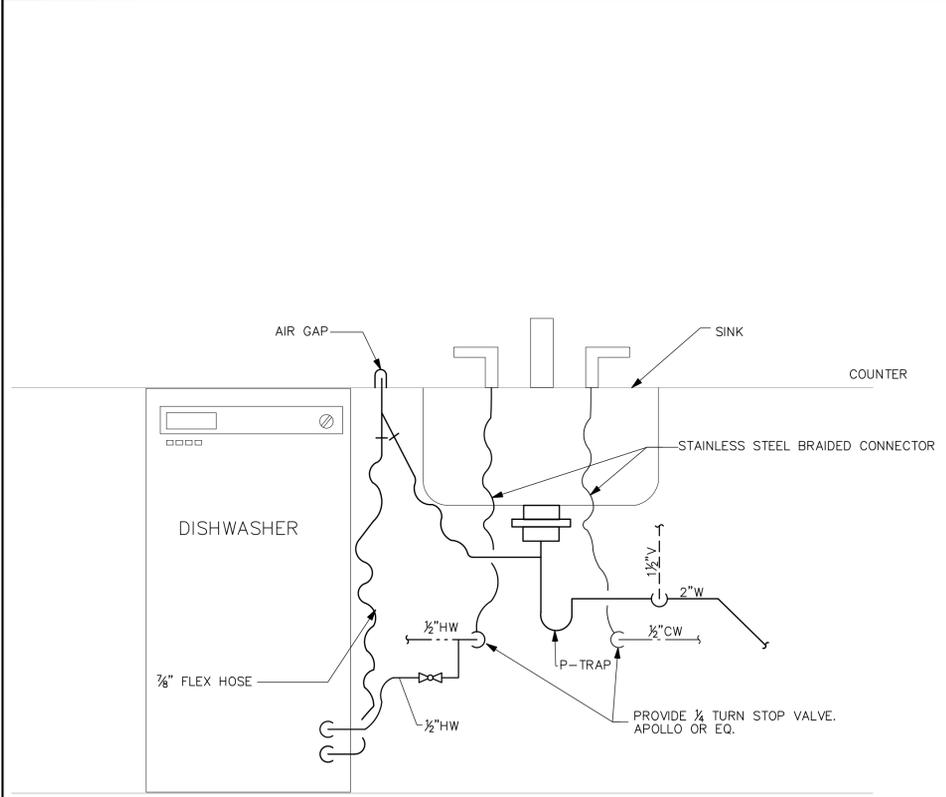

RESIDENTIAL DISHWASHER CONNECTION
DETAIL
 SCALE: NONE


6
P4.01

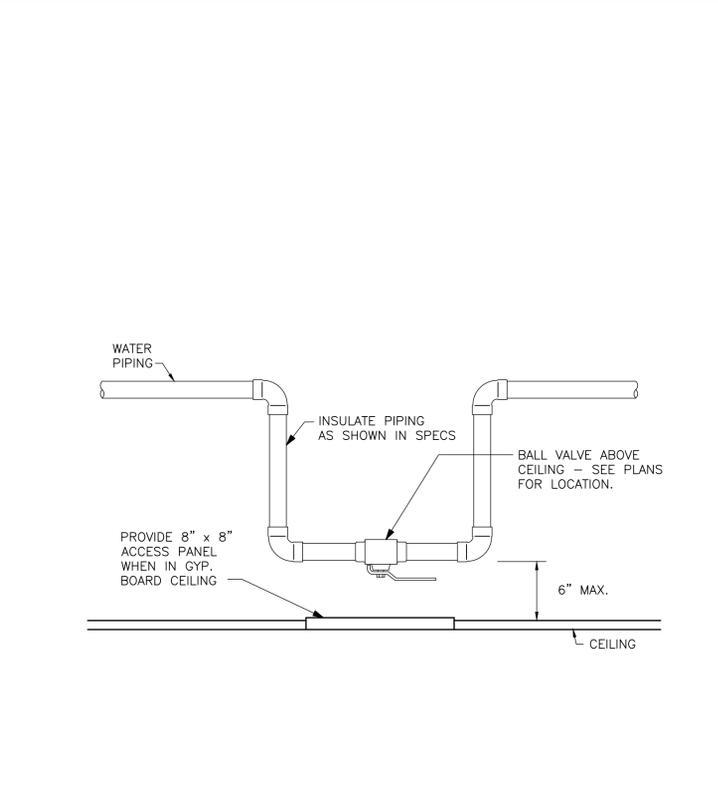

TYPICAL VALVE PLACEMENT
DETAIL
 SCALE: NONE


5
P4.01

- NOTES:
1. MINIMUM BEND RADIUS FOR PEX PIPING IS 6 TIMES THE TUBING DIAMETER.
 2. FOR UNUSED PORTS, INSTALL VALVE AND CAP FOR FUTURE USE.
 3. REFER TO PLUMBING RISER DIAGRAM FOR PIPE SIZING FROM RISERS.
 4. PROVIDE GROMMETS OR SLEEVES PER MANUFACTURER'S RECOMMENDATIONS WHERE PEX PASSES THROUGH METAL STUDS AND WHERE PIPE ABRASION COULD OCCUR.
 5. PROVIDE SHUT OFF VALVE TO MAINS.
 6. PEX RUNOUT PIPING SHALL MEET THE FOLLOWING REQUIREMENTS:
 - 6.1. MAX WATER VOLUME ALLOWED PER 2018 WSEC 403.2 FOR HOT WATER RUNOUTS IS 0.5 GALLONS.

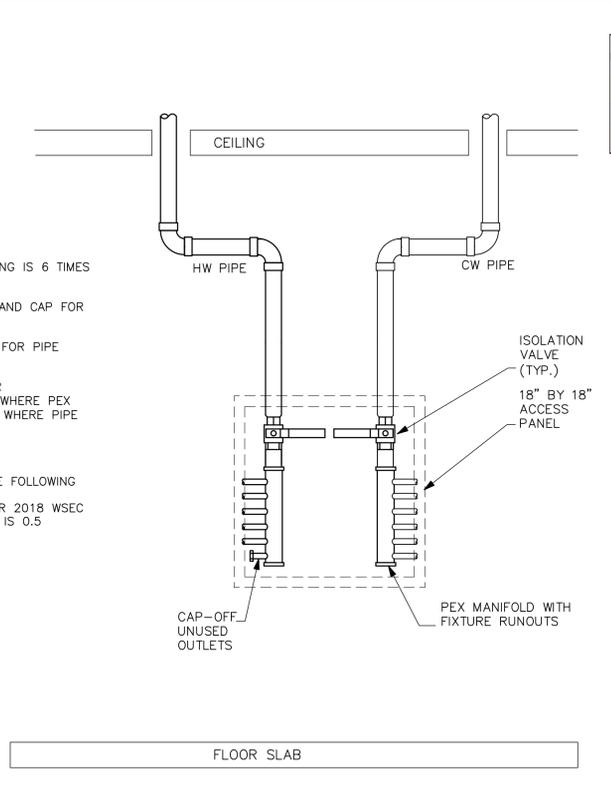


PEX MANIFOLD
DETAIL
 SCALE: NONE

4
P4.01

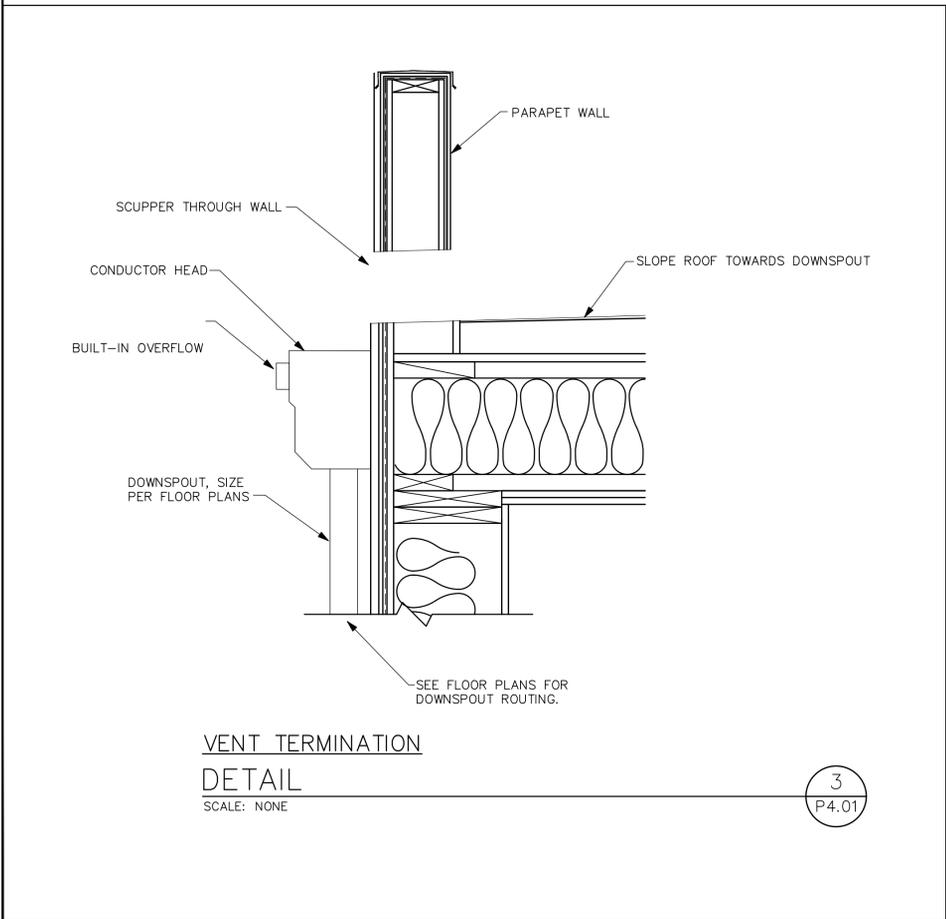


VENT TERMINATION
DETAIL
 SCALE: NONE

3
P4.01

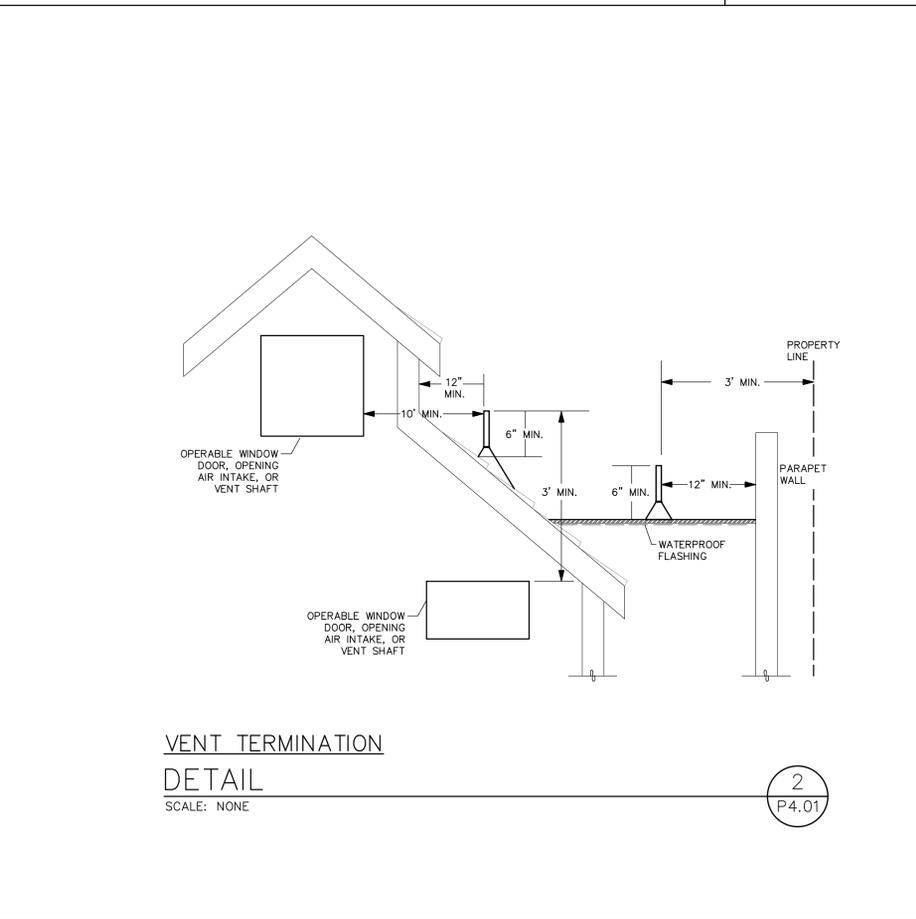

VENT TERMINATION
DETAIL
 SCALE: NONE

2
P4.01

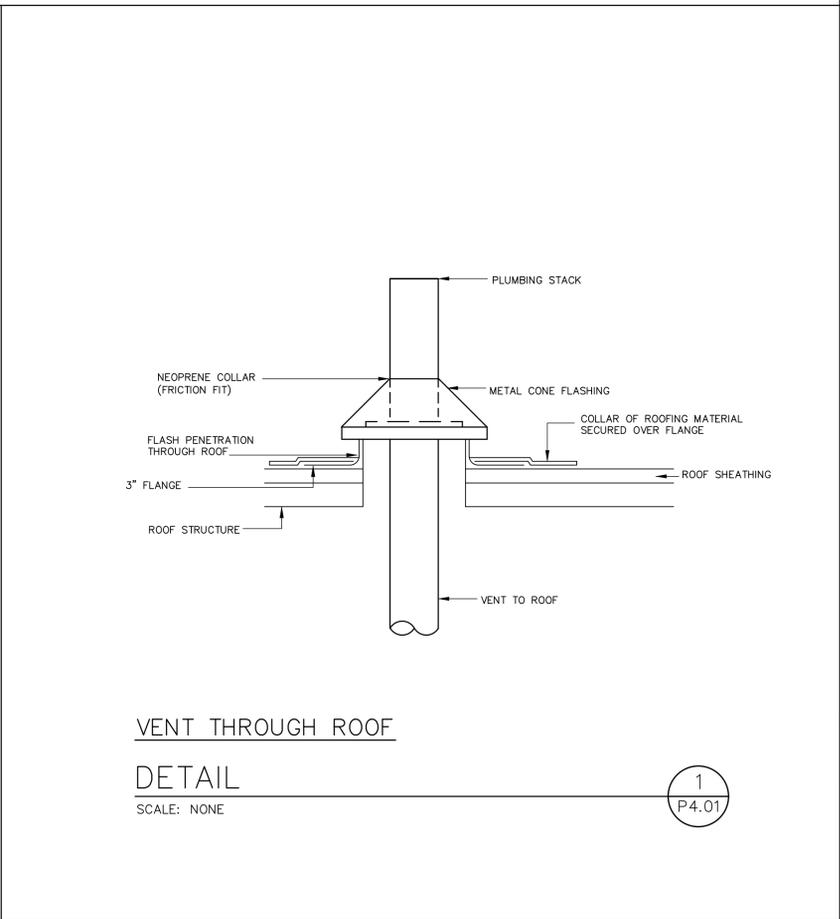

VENT THROUGH ROOF
DETAIL
 SCALE: NONE

1
P4.01

PROJECT: **EAST TOWN CROSSING - BUILDING A**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

DATE: 8-29-2025

SHEET TITLE: DETAILS

SHEET NO. **P4A.1**

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-964-3343

ROBISON ENGINEERING, INC.

NO.	DATE	DESCRIPTION
1	8/29	PERMIT RESUBMITTAL #2



JMN	JMN	JMN	JMN
DRAWN:	DESIGNED:	CHECKED:	APPROVED:

PROJECT: EAST TOWN CROSSING - BUILDING A
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

ROBISON ENGINEERING, INC.
 19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-864-3343

DATE:
8-29-2025

SHEET TITLE:
WASTE & VENT
RISER DIAGRAMS

SHEET NO.
P5A.0

GENERAL NOTES


1. PROVIDE TRAP PRIMERS FOR ALL FLOOR DRAINS PER 2019 UPC 1007.1. SEE DETAIL 2/P901.
2. PROVIDE EXPANSION LOOPS FOR ALL WATER PIPING PER THE MANUFACTURER'S INSTRUCTIONS. SEE DETAIL 5/P900.
3. WATER PIPES ARE SIZED PER THE WATER SUPPLY PRESSURE CALCULATION ON P002.

ABBREVIATION LEGEND:

- LV = LAVATORY (1 WSFU)
 BT = BATHTUB (4 WSFU)
 KS = KITCHEN SINK WITH DISHWASHER (3 WSFU)
 WB = WASHER BOX (4 WSFU)
 WC = WATER CLOSET (2.5 WSFU)

FLAG NOTES

1. WATER SUB-METER AND PEX MANIFOLD. SEE DETAIL 3/P900.
2. PROVIDE SHUT-OFF VALVES AT THE BOTTOM OF EACH RISER LOCATED TOP OF SLAB.

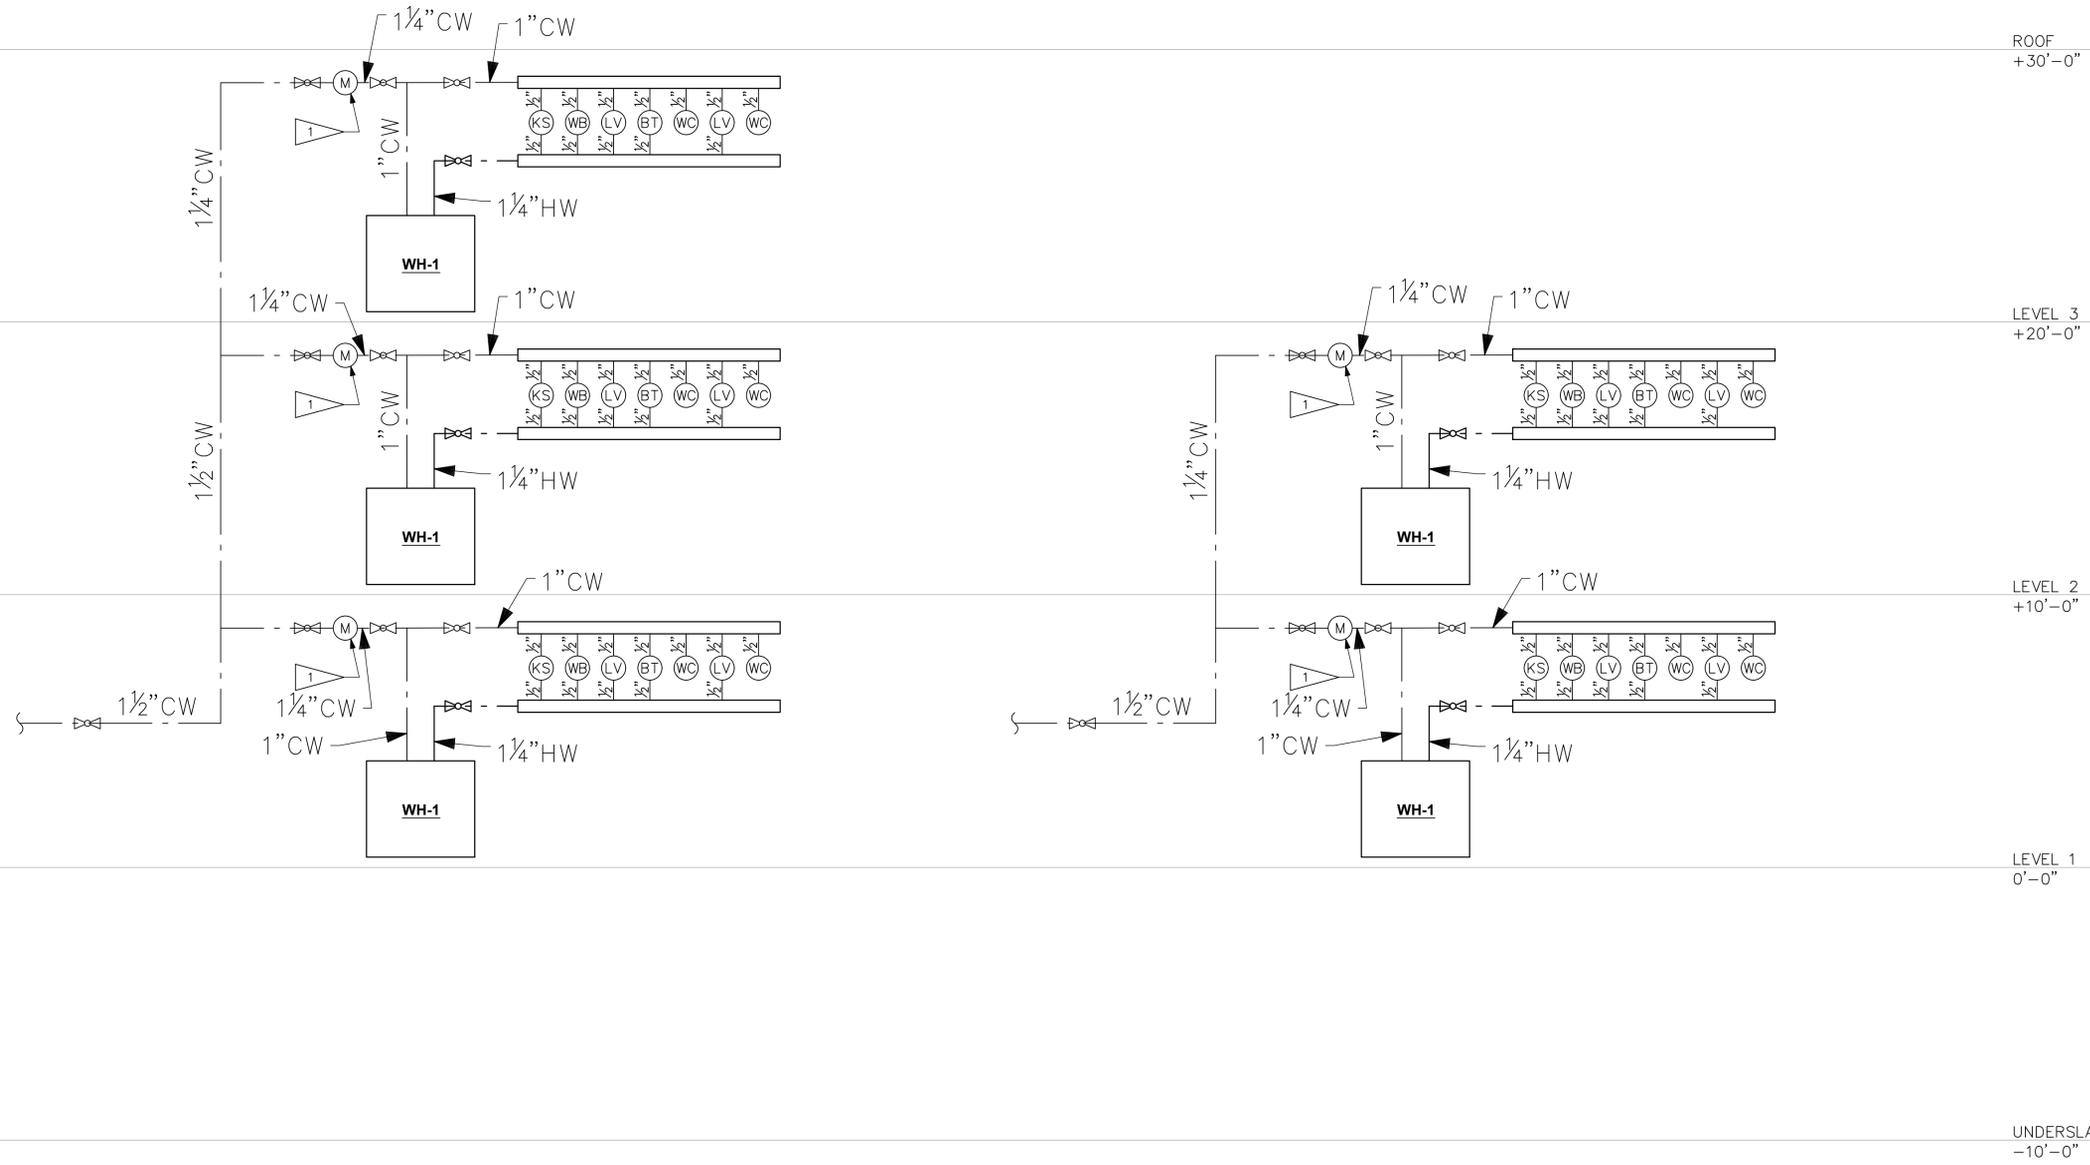

SUPPLY RISER DIAGRAM
 SCALE: NONE S
2

SUPPLY RISER DIAGRAM
 SCALE: NONE S
1

NO.	DATE	DESCRIPTION
1	8/29	PERMIT RESUBMITTAL #2



JMN	JMN	JMN	JMN
DRAWN:	DESIGNED:	CHECKED:	APPROVED:

PROJECT: **EAST TOWN CROSSING - BUILDING A**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-864-3343

ROBISON ENGINEERING, INC.

DATE:
 8-29-2025

SHEET TITLE:
 WASTE & VENT
 RISER DIAGRAMS

SHEET NO.
P6A.0

GENERAL NOTES

- PROVIDE TRAP PRIMERS FOR ALL FLOOR DRAINS PER 2018 UPC 1007.1. SEE DETAIL 6/P901.
- WASTE & VENT SIZING: WASTE & VENT PIPING IS SIZED PER 2018 UPC TABLE 703.2. DRAINAGE PIPING SHALL BE SLOPED AT 1/4" PER FOOT OR 2%. WHERE IT IS IMPRACTICAL TO OBTAIN A SLOPE OF 2% DUE TO THE DEPTH OF THE STREET SEWER OR TO STRUCTURAL FEATURES OF THE BUILDING, DRAINAGE PIPING MAY BE SLOPED AT 1/8" PER FOOT OR 1% WITH APPROVAL FROM THE AHJ.
- PROVIDE EXPANSION JOINTS FOR PVC WASTE AND VENT STACKS THAT EXCEED 30' PER 2018 UPC TABLE 313.3 AND MANUFACTURER INSTALLATION INSTRUCTIONS.
- PROVIDE CLEANOUTS FOR WASTE STACKS AND KITCHEN SINK DRAINS AT THE LOWEST LEVEL PER 2018 UPC SECTION 707.0.


PIPE SIZE	VERTICAL	HORIZONTAL	VENT
1 1/2"	2 DFU	1 DFU	8 DFU
2"	16 DFU	8 DFU	24 DFU
3"	48 DFU	35 DFU	84 DFU
4"	256 DFU	216 DFU	256 DFU
6"	1,380 DFU	720 DFU	1,380 DFU
8"	3,600 DFU	2,640 DFU	3,600 DFU

ABBREVIATION LEGEND:

LV = LAVATORY	(1 DFU)
BT = BATHTUB	(2 DFU)
KS = KITCHEN SINK WITH DISHWASHER	(2 DFU)
WB = WASHER BOX	(3 DFU)
WC = WATER CLOSET	(3 DFU)
FD = FLOOR DRAIN	(2 DFU)
FS = FLOOR SINK	(4 DFU)
HD = HUB DRAIN	(8 DFU)
SH = SHOWER	(2 DFU)

= WASTE/VENT RISER IDENTIFICATION (I.E. RISER "#").

FLAG NOTES

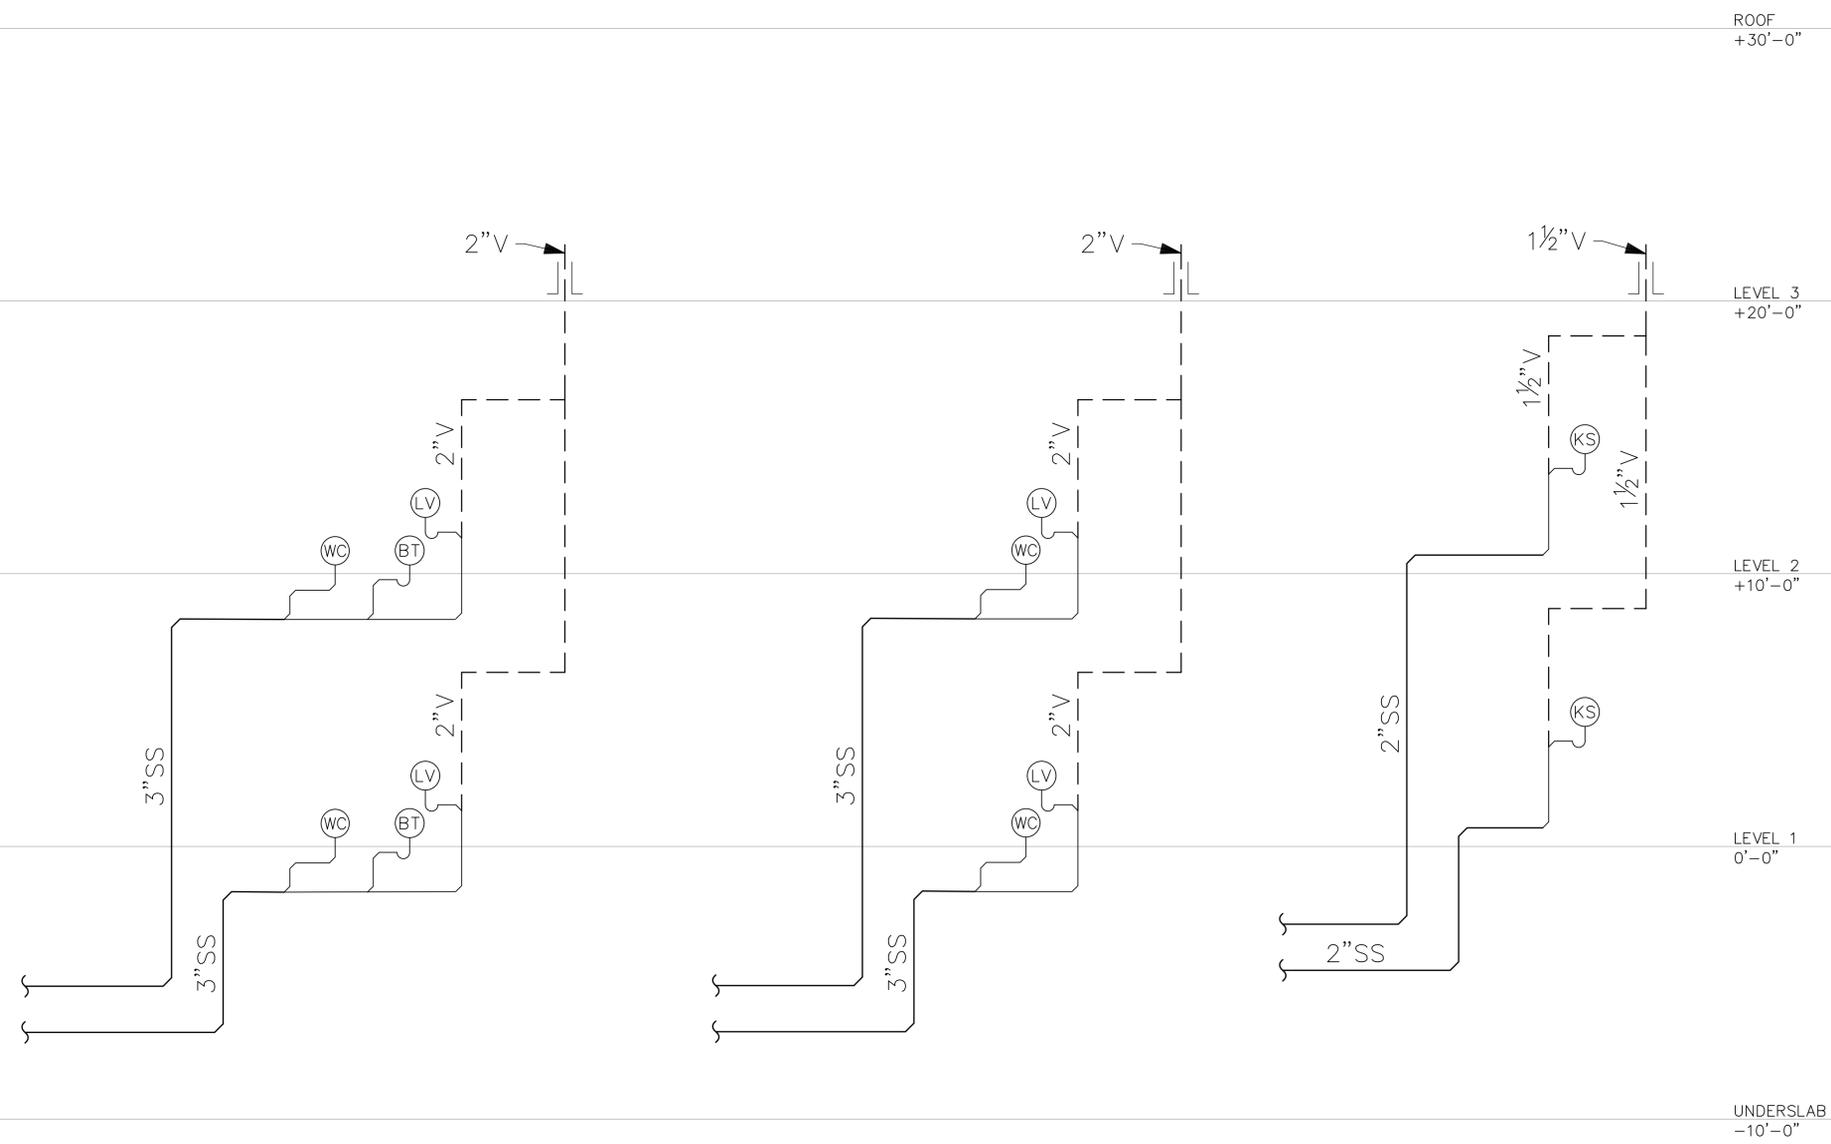

RISER DIAGRAM
 SCALE: NONE

RISER DIAGRAM
 SCALE: NONE

RISER DIAGRAM
 SCALE: NONE

NO.	DATE	DESCRIPTION
1	8/29	PERMIT RESUBMITTAL #2



DRAWN:	DESIGNED:	CHECKED:	APPROVED:
JMN	JMN	JMN	JMN

PROJECT: **EAST TOWN CROSSING - BUILDING A**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-864-3343

ROBISON ENGINEERING, INC.

DATE:
 8-29-2025

SHEET TITLE:
 WASTE & VENT
 RISER DIAGRAMS

SHEET NO.
P6A.1

GENERAL NOTES

- PROVIDE TRAP PRIMERS FOR ALL FLOOR DRAINS PER 2018 UPC 1007.1. SEE DETAIL 6/P901.
- WASTE & VENT SIZING: WASTE & VENT PIPING IS SIZED PER 2018 UPC TABLE 703.2. DRAINAGE PIPING SHALL BE SLOPED AT 1/4" PER FOOT OR 2%. WHERE IT IS IMPRACTICAL TO OBTAIN A SLOPE OF 2% DUE TO THE DEPTH OF THE STREET SEWER OR TO STRUCTURAL FEATURES OF THE BUILDING, DRAINAGE PIPING MAY BE SLOPED AT 1/8" PER FOOT OR 1% WITH APPROVAL FROM THE AHJ.
- PROVIDE EXPANSION JOINTS FOR PVC WASTE AND VENT STACKS THAT EXCEED 30' PER 2018 UPC TABLE 313.3 AND MANUFACTURER INSTALLATION INSTRUCTIONS.
- PROVIDE CLEANOUTS FOR WASTE STACKS AND KITCHEN SINK DRAINS AT THE LOWEST LEVEL PER 2018 UPC SECTION 707.0.


PIPE SIZE	VERTICAL	HORIZONTAL	VENT
1 1/2"	2 DFU	1 DFU	8 DFU
2"	16 DFU	8 DFU	24 DFU
3"	48 DFU	35 DFU	84 DFU
4"	256 DFU	216 DFU	256 DFU
6"	1,380 DFU	720 DFU	1,380 DFU
8"	3,600 DFU	2,640 DFU	3,600 DFU

ABBREVIATION LEGEND:

LV = LAVATORY	(1 DFU)
BT = BATHTUB	(2 DFU)
KS = KITCHEN SINK WITH DISHWASHER	(2 DFU)
WB = WASHER BOX	(3 DFU)
WC = WATER CLOSET	(3 DFU)
FD = FLOOR DRAIN	(2 DFU)
FS = FLOOR SINK	(4 DFU)
HD = HUB DRAIN	(8 DFU)
SH = SHOWER	(2 DFU)

 = WASTE/VENT RISER IDENTIFICATION (I.E. RISER "#").

FLAG NOTES 

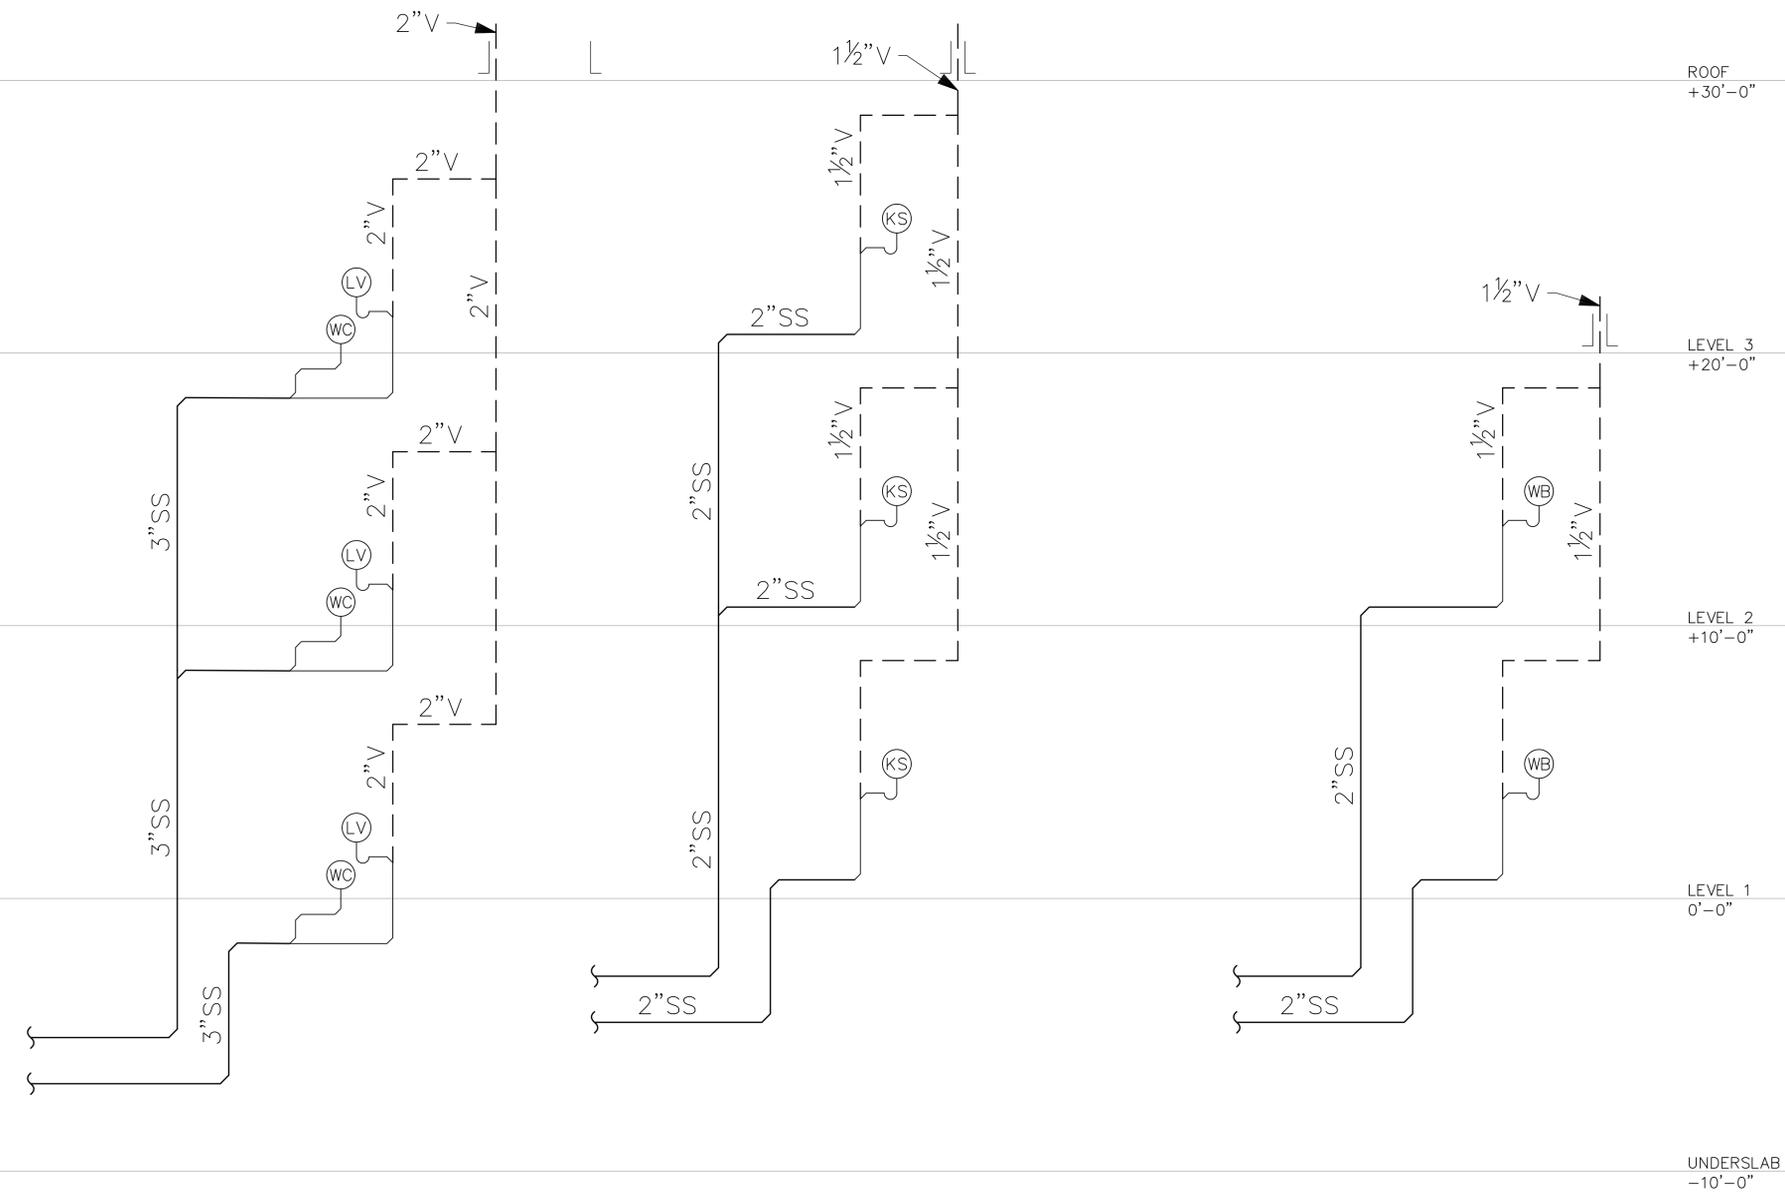

RISER DIAGRAM
 SCALE: NONE 

RISER DIAGRAM
 SCALE: NONE 

RISER DIAGRAM
 SCALE: NONE 

NO.	DATE	DESCRIPTION
1	8/29	PERMIT RESUBMITTAL #2



DRAWN:	JMN
DESIGNED:	JMN
CHECKED:	JMN
APPROVED:	JMN

PROJECT: **EAST TOWN CROSSING - BUILDING A**
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206-864-3343

ROBISON ENGINEERING, INC.

DATE:
8-29-2025

SHEET TITLE:
WASTE & VENT
RISER DIAGRAMS

SHEET NO.

P6A.2

GENERAL NOTES

- PROVIDE TRAP PRIMERS FOR ALL FLOOR DRAINS PER 2018 UPC 1007.1. SEE DETAIL 6/P901.
- WASTE & VENT SIZING: WASTE & VENT PIPING IS SIZED PER 2018 UPC TABLE 703.2. DRAINAGE PIPING SHALL BE SLOPED AT 1/4" PER FOOT OR 2%, WHERE IT IS IMPRACTICAL TO OBTAIN A SLOPE OF 2% DUE TO THE DEPTH OF THE STREET SEWER OR TO STRUCTURAL FEATURES OF THE BUILDING, DRAINAGE PIPING MAY BE SLOPED AT 1/8" PER FOOT OR 1% WITH APPROVAL FROM THE AHJ.
- PROVIDE EXPANSION JOINTS FOR PVC WASTE AND VENT STACKS THAT EXCEED 30' PER 2018 UPC TABLE 313.3 AND MANUFACTURER INSTALLATION INSTRUCTIONS.
- PROVIDE CLEANOUTS FOR WASTE STACKS AND KITCHEN SINK DRAINS AT THE LOWEST LEVEL PER 2018 UPC SECTION 707.0.


PIPE SIZE	VERTICAL	HORIZONTAL	VENT
1 1/2"	2 DFU	1 DFU	8 DFU
2"	16 DFU	8 DFU	24 DFU
3"	48 DFU	35 DFU	84 DFU
4"	256 DFU	216 DFU	256 DFU
6"	1,380 DFU	720 DFU	1,380 DFU
8"	3,600 DFU	2,640 DFU	3,600 DFU

ABBREVIATION LEGEND:

LV = LAVATORY	(1 DFU)
BT = BATHTUB	(2 DFU)
KS = KITCHEN SINK WITH DISHWASHER	(2 DFU)
WB = WASHER BOX	(3 DFU)
WC = WATER CLOSET	(3 DFU)
FD = FLOOR DRAIN	(2 DFU)
FS = FLOOR SINK	(4 DFU)
HD = HUB DRAIN	(8 DFU)
SH = SHOWER	(2 DFU)

= WASTE/VENT RISER IDENTIFICATION (I.E. RISER "#").

FLAG NOTES

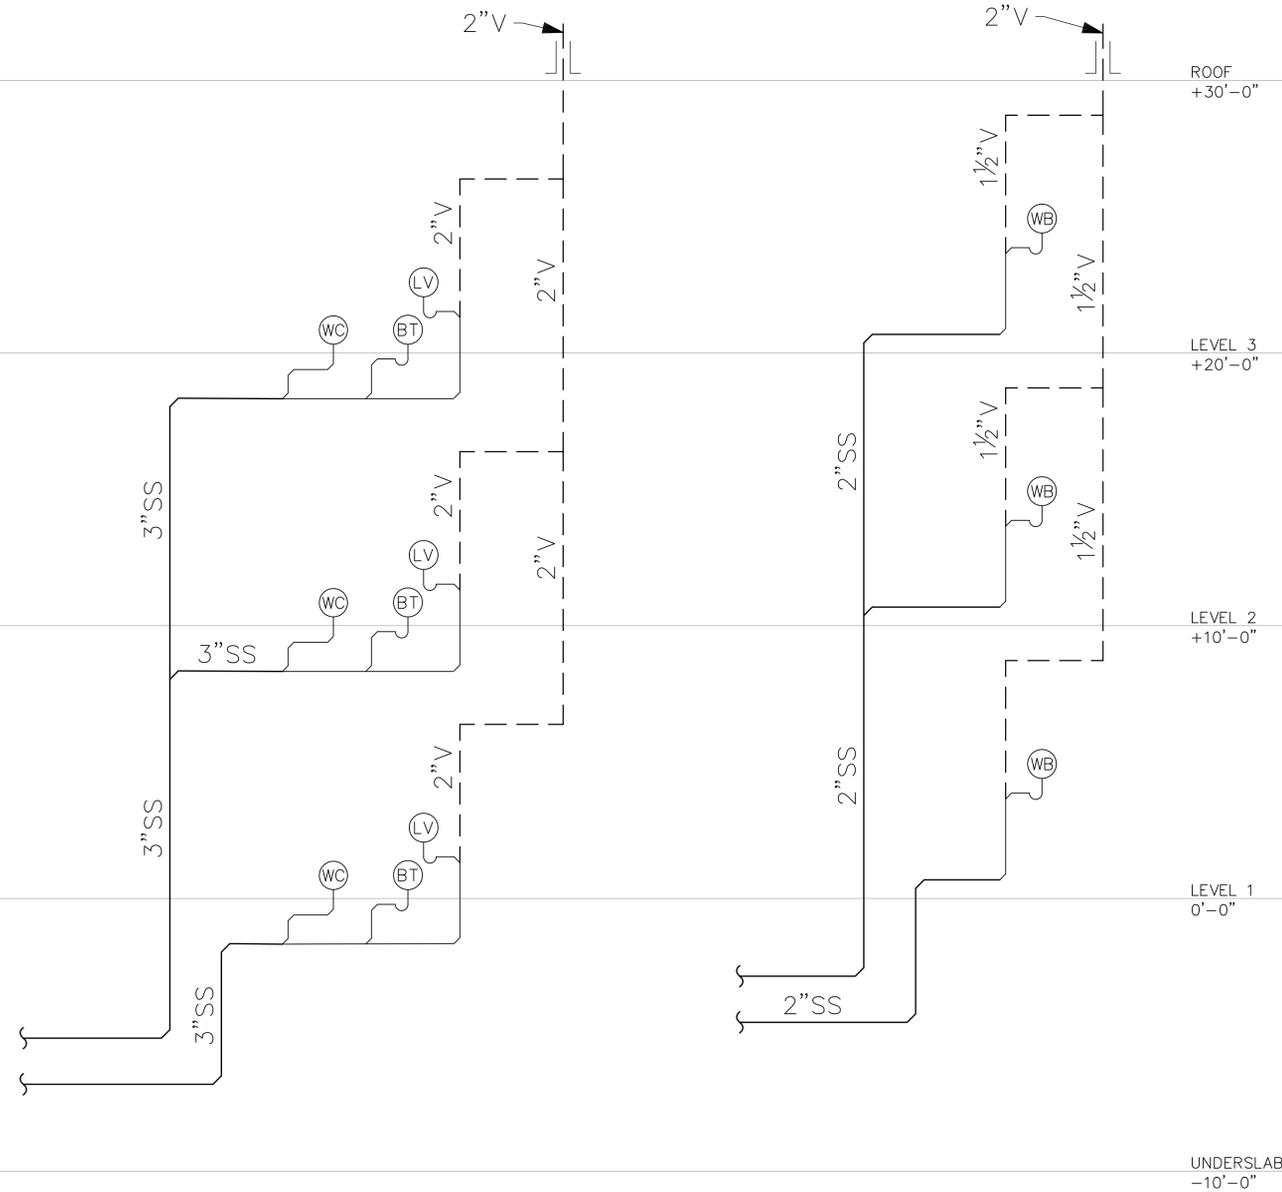

RISER DIAGRAM
SCALE: NONE



RISER DIAGRAM
SCALE: NONE




SYMBOLS

GENERAL

LIGHT LINE INDICATES NON-ELECTRICAL OR BACKGROUND (THIS IS NOT CONTRACTUAL DEFINITION OF WORK)
HEAVY LINE INDICATES NEW WORK (THIS IS NOT CONTRACTUAL DEFINITION OF WORK)

DETAIL IDENTIFICATION

SYMBOL



NAME

FLAG NOTE



REVISION NOTE


REVISION DEFINITION, AREA ENCLOSED CONTAINS DRAWING CHANGES MADE SUBSEQUENT TO PREVIOUS ISSUE

SWITCHES




SWITCH, SINGLE POLE; WITH SWITCHING SUBSCRIPT
OCCUPANCY SENSOR SWITCH
SWITCH, SINGLE POLE; WITH SWITCHING SUBSCRIPT "D" INDICATES WALLBOX DIMMER
CEILING MOUNTED OCCUPANCY SENSOR
SWITCH, TIMER.
SWITCH, THREE WAY.

RECEPTACLES



SINGLE RECEPTACLE
DUPLEX RECEPTACLE: WALL MOUNTED, +18" AFF
CONTROLLED AND NON CONTROLLED DUPLEX RECEPTACLE (SPLIT WIRED RECEPTACLE)
DUPLEX RECEPTACLE - ABOVE COUNTER
DUPLEX GFCI ABOVE COUNTER
DUPLEX GFCI
DUPLEX RECEPTACLE, WITH HEIGHT ABOVE FINISHED FLOOR INDICATED
CEILING MOUNTED DUPLEX RECEPTACLE
DOUBLE DUPLEX RECEPTACLE: WALL MOUNTED, +18" AFF
FLOOR BOX ONE DUPLEX RECEPTACLE
FLOOR BOX ONE DUPLEX RECEPTACLE + ONE DATA
FLOOR BOX ONE DUPLEX RECEPTACLE + ONE DATA + ONE VOICE
SPECIAL PURPOSE RECEPTACLE, AS NOTED

MISCELLANEOUS



JUNCTION BOX: 4SQ MOUNTED
JUNCTION BOX: 4SQ WALL MOUNTED
JUNCTION BOX: 4SQ TRACK
CONNECTION FOR LIGHTED MIRROR COORDINATE LOCATION AND ELEVATION WITH ARCHITECT PRIOR TO ROUGH-IN
THERMOSTAT

SIGNAL/COMMUNICATION



DATA OUTLET: WALL MOUNTED @ +18" AFF U.O.N.
TELEPHONE/DATA OUTLET: WALL MOUNTED @ +18" AFF U.O.N.
TELEVISION OUTLET: WALL MOUNTED @ +18" AFF U.O.N.

POWER



PANELBOARD
NON-FUSED DISCONNECT SWITCH (WP = NEMA 3R WHERE APPROPRIATE)
FUSED DISCONNECT SWITCH



MOTOR CONNECTION (EQUIPMENT NAME, HORSEPOWER, VOLTAGE, AND PHASE INDICATED)




EQUIPMENT CONNECTION (EQUIPMENT NAME, LOAD, VOLTAGE, AND PHASE INDICATED)



TRANSFORMER, DRY TYPE, SHOWN TO SCALE



KW METER AND BASE



FIRE ALARM SYSTEM CONTROL PANEL
FIRE ALARM SYSTEM PULL STATION
FIRE ALARM SYSTEM STROBE/SPEAKER
FIRE ALARM PHOTOELECTRIC SMOKE DETECTOR AND SPEAKER.
FIRE ALARM COMBINATION PHOTOELECTRIC SMOKE DETECTOR, CARBON MONOXIDE DETECTOR, AND SPEAKER, GUESTROOM.
CARBON MONOXIDE DETECTOR.
ELECTRO-MAGNETIC DOOR HOLDER
DUCT SMOKE DETECTOR

ABBREVIATIONS

Table listing abbreviations and their full names, such as AC for Alternating Current, AWG for American Wire Gauge, and GFCI for Ground Fault Circuit Interrupter.

GENERAL NOTES

GENERAL

- 1. PROVIDE ELECTRICAL INSTALLATION IN ACCORDANCE WITH THE GOVERNING ELECTRICAL CODE, LOCAL CODES, ORDINANCES AND REQUIREMENTS OF UTILITY COMPANIES FURNISHING SERVICES TO INSTALLATION.
2. PROVIDE ALL WORK AND ITEMS NECESSARY FOR COMPLETE AND FUNCTIONAL ELECTRICAL SYSTEMS. THE ELECTRICAL DRAWINGS ARE DIAGRAMMATIC AND DO NOT NECESSARILY SHOW EVERY CONDUIT, BOX, CONDUCTOR OR SIMILAR ITEMS FOR A COMPLETE INSTALLATION.
3. THE CONTRACTOR SHALL VISIT THE SITE PRIOR TO BID AND DETERMINE CONDITIONS WHICH MAY AFFECT BID. ANY ITEMS NOT FULLY UNDERSTOOD SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT PRIOR TO BIDDING.
4. "REF" INDICATIONS DENOTE WORK COVERED ELSEWHERE (ARCHITECTURAL, STRUCTURAL, OR MECHANICAL).
5. REFERENCE ARCHITECTURAL DRAWING FOR EXACT LOCATION OF DEVICES. QUESTIONS CONCERNING THE LOCATION OF DEVICES AND EQUIPMENT SHALL BE DIRECTED TO THE ARCHITECT. FAILURE TO COORDINATE REQUIREMENTS SHALL IN NO WAY RESULT IN ADDITIONAL COMPENSATION BEING PROVIDED TO THE CONTRACTOR.
6. WHEREVER THE WORD "PROVIDE" IS USED, IT MEANS, "FURNISH AND INSTALL COMPLETE AND READY FOR USE."
7. COORDINATE LOCATION OF ELECTRICAL WITH OTHER TRADES.
8. REFER TO EQUIPMENT DRAWINGS FOR MECHANICAL CHARACTERISTICS (SIZE, LOCATION, ETC.) OF MECHANICAL EQUIPMENT, UNLESS OTHERWISE INDICATED. COORDINATE INSTALLATION AND LOCATION OF ALL EQUIPMENT WITH MECHANICAL CONTRACTOR. VERIFY ALL FUSE RATINGS, WIRE SIZES AND DISCONNECT SIZES PRIOR TO INSTALLATION.

MATERIALS AND METHODS

- 1. PROVIDE RACEWAY AND WIRING ROUTED CONCEALED WITHIN BUILDING STRUCTURE WHERE POSSIBLE. WHERE RACEWAY CANNOT BE CONCEALED, IT SHALL BE INSTALLED PER PROJECT MANAGER'S DIRECTION. ALL CONDUIT SHALL BE INSTALLED IN NEAT SYMMETRICAL LINES HORIZONTAL OR PERPENDICULAR TO BUILDING COLUMNS AND ROOF LINES. CONDUITS SHALL BE GROUPED ON COMMON SUPPORTS WHEREVER POSSIBLE.
2. EXPOSED CONDUIT ROUTING: CONDUITS MAY BE ROUTED EXPOSED IN MECHANICAL AND ELECTRICAL ROOMS ONLY. EXPOSED CONDUITS SHALL BE SECURED A MINIMUM OF 6" ABOVE FLOOR.
3. OUTDOOR EXPOSED CONDUIT ROUTING: CONDUITS ROUTED ON ROOF OR EXPOSED TO WEATHER SHALL BE GRC, PVC OR LIQUID-TIGHT FLEX. PROVIDE WATER-TIGHT CONNECTIONS AND FITTINGS.
4. CLEARANCES: VERIFY PHYSICAL DIMENSIONS OF EQUIPMENT TO ENSURE THAT ACCESS CLEARANCES CAN BE MET.
5. CONNECTIONS: PROVIDE GRS, METALLIC FLEX, OR LIQUIDTITE FLEX CONDUITS FOR CONNECTIONS TO MOTORS OR MOTORIZED EQUIPMENT.
6. WIRING: PROVIDE MINIMUM #12 AWG WIRE SIZE. IF CONDUIT IS TO BE USED MINIMUM IS TO BE 1/2". FLEXIBLE CONDUIT AND FLEXIBLE CABLE IS PERMISSIBLE THROUGHOUT THE BUILDING.

- 7. WIRING: PROVIDE MINIMUM #10 AWG COPPER CONDUCTOR SIZE IN 120V BRANCH CIRCUIT RUNS OVER 75' IN LENGTH.
SITE ELECTRICAL
1. TRENCHING: COORDINATE ALL TRENCHING WORK WITH OTHER UTILITY LOCATIONS AND DRAINAGE TRENCHES.
2. UNDERGROUND CONDUITS: PROVIDE PVC, SCHEDULE 40, 3/4" MINIMUM. PROVIDE GRC CONDUIT TRANSITION ELBOW WHEN TURNING UP TO ABOVE GRADE.
3. DIRECT-BURIED CONDUITS: CONDUIT FOR BRANCH CIRCUITS OUTSIDE BUILDINGS NOT BENEATH DRIVEWAYS OR PARKING AREAS SHALL BE DIRECTLY BURIED WITHOUT CONCRETE ENCASEMENT. THE DEPTH TO THE TOP OF BURIED CONDUITS SHALL BE 36". PROVIDE MARKER TAPE 12" BELOW GRADE.
4. BELOW SLAB: CONDUIT ROUTED BELOW ON-GRADE FLOOR SLABS SHALL BE INSTALLED PRIOR TO FLOOR SLAB POUR. ROUTE CONDUITS BELOW SLAB AS STRAIGHT AS POSSIBLE TO MINIMIZE BENDS.
5. ALL CONDUITS PENETRATING THE BUILDING ENVELOPE BELOW GRADE SHALL FOLLOW WATERPROOFING REQUIREMENTS IN THE ARCHITECTURAL DRAWINGS.

NEUTRALS

- 1. AT CONTRACTORS OPTION, NEUTRALS MAY BE SHARED ON COMBINED HOMERUNS UNLESS THE CIRCUIT HAS A GFCI BREAKER, AN ISOLATED GROUND, OR IS FROM A PANEL WITH TVSS PROTECTION. ANY NEUTRAL DOWNSTREAM FROM A DIMMER SHALL BE DEDICATED TO THE DIMMED LOAD.
2. NEUTRAL WIRES SHOWN FOR TWO AND THREE POLE MECHANICAL AND KITCHEN EQUIPMENT MAY BE OMITTED UPON VERIFICATION THAT THEY ARE NOT REQUIRED EITHER FOR OPERATION OR CONTROL CIRCUITS PER MANUFACTURER'S SPECIFICATIONS.

LIGHTING

- 1. PROVIDE LIGHT FIXTURES WITH PROPER FITTING FLANGES, MOUNTING SUPPORTS, AND ACCESSORY ITEMS, UL LISTED FOR CONDITIONS OF USE.
LOW VOLTAGE LIGHTING
1. PROVIDE LOW VOLTAGE TRANSFORMERS IN NEARBY ACCESSIBLE CEILING SPACE.
2. PROVIDE LOW VOLTAGE CONDUCTORS SIZED PER MANUFACTURER'S GUIDELINES TO MINIMIZE VOLTAGE DROP.

LIGHTING CONTROL

- 1. THE MAXIMUM LIGHTING POWER THAT MAY BE CONTROLLED FROM A SINGLE SWITCH OR AUTOMATIC CONTROL SHALL NOT EXCEED THAT WHICH IS PROVIDED BY A TWENTY AMPERE CIRCUIT LOADED TO NOT MORE THAN EIGHTY PERCENT. A MASTER CONTROL MAY BE INSTALLED PROVIDED THE INDIVIDUAL SWITCHES RETAIN THEIR CAPABILITY TO FUNCTION INDEPENDENTLY.
2. EMERGENCY FIXTURES: EMERGENCY BATTERY/CHARGER SHALL BE CONNECTED TO AN UNSWITCHED LEG OF THE DESIGNATED CIRCUIT.

GENERAL REQUIREMENTS

- 1. DRAWINGS ARE DIAGRAMMATIC, SHOWING THE GENERAL LOCATION, TYPE, LAYOUT, AND EQUIPMENT REQUIRED.
2. THE DRAWINGS SHALL NOT BE SCALED FOR EXACT MEASUREMENT.
3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS.
4. REFER TO MANUFACTURER'S STANDARD INSTALLATION DRAWINGS FOR EQUIPMENT CONNECTIONS AND INSTALLATION REQUIREMENTS.
5. PROVIDE CONNECTIONS, ACCESSORIES, OFFSETS, AND MATERIALS NECESSARY FOR A COMPLETE SYSTEM.

CONTRACTOR SUBSTITUTIONS & REVISIONS

- 1. PLEASE SUBMIT PROPOSALS FOR SUBSTITUTIONS OR REVISIONS FOR REVIEW AND APPROVAL PRIOR TO ORDERING MATERIAL OR DOING WORK.
2. FOR EQUIPMENT THAT IS SCHEDULED BY MANUFACTURER'S NAME AND CATALOG DESIGNATIONS, THE MANUFACTURER'S PUBLISHED DATA AND/OR SPECIFICATION FOR THAT ITEM ARE CONSIDERED PART OF SPECIFICATION.
3. ENGINEERING COSTS FOR REVISING MEP PLANS SHALL BE ADDRESSED IN THE COST ANALYSIS OF THE SUBSTITUTION PROPOSAL.
4. CONTRACTOR TO COORDINATE WITH ENGINEER AND DETERMINE ASSOCIATED DESIGN AND PERMITTING COSTS. CONTRACTOR SHALL BE RESPONSIBLE FOR OTHER COSTS ASSOCIATED WITH UNFORESEEN ISSUES RESULTING FROM SUBSTITUTIONS OR REVISIONS.

PRE-CON MEETING NOTES

CONTRACTORS SHALL ATTEND A PRE-CONSTRUCTION MEETING WITH THE ENGINEER FOR THE PURPOSE OF REVIEWING THE WORK PRIOR TO ORDERING ANY EQUIPMENT OR PERFORMING ANY WORK. THE MEETING SHALL BE LOCATED AT THE PROJECT SITE ON A DATE AND TIME TO BE MUTUALLY AGREED. THE MEETING WILL BE A WORKING SESSION. THE MEETING WILL BE FACILITATED BY THE ENGINEER AND THE AGENDA WILL INCLUDE A DETAILED REVIEW OF THE PLANS AND SPECIFICATIONS, CROSS CHECK WITH OTHER TRADES FOR COORDINATION ISSUES, REVIEW OF PROPOSED PRODUCTS, REVIEW OF PLANNED MEANS AND METHODS, AND ON-SITE INVESTIGATION OF FIELD CONDITIONS RELATIVE TO EXISTING CONDITIONS THAT COULD AFFECT THE WORK. PERSONS ATTENDING THE MEETING SHALL BE KNOWLEDGEABLE OF THE PROJECT AND SHALL BE THE SPECIFIC PERSONS INTENDED TO CONTINUE WITH THE PROJECT THROUGH TO COMPLETION. IF REQUIRED, REVISED PLANS WILL BE ISSUED THROUGH OFFICIAL CHANNELS. CHANGES IN THE BID PRICE WILL BE DISCUSSED, BUT NO CHANGE ORDERS WILL BE ISSUED UNLESS PROCESSED THROUGH OFFICIAL CHANNELS. IT SHALL BE UNDERSTOOD THAT THE ENGINEER HAS NO AUTHORITY TO ISSUE CHANGE ORDERS.

THE FOLLOWING TRADES SHALL BE REPRESENTED FOR THE MINIMUM TIME INDICATED:

Table listing trades and their required hours: MECHANICAL SHEET METAL (4 HOURS), PLUMBING/PIPING (4 HOURS), ELECTRICAL (4 HOURS), SPRINKLER (2 HOURS), GENERAL CONTRACTOR (ALL SESSIONS).

DRAWING INDEX

Table with columns for DWG, DESCRIPTION, REVIEW SET, and PERMIT SET. It lists various drawings like LEGEND, GENERAL NOTES, DRAWING INDEX, SITE POWER PLAN, and LIGHTING PLANS.



Separate Electrical Permit is required with the Washington State Department of Labor & Industries.
https://lni.wa.gov/licensing-permits/electrical/electrical-permits-fees-and-inspections
or call for Licensing Information: 1-800-647-0982

Table for REVISIONS and DATE, with columns for revision number, description, and date.



Table for project approval: DRAWN: LYSAK K., DESIGNED: LYSAK K., CHECKED: STEINKE M., APPROVED: STEINKE M.


PROJECT: EAST TOWN CROSSING BUILDING A MULTIFAMILY DEVELOPMENT PIONEER WAY & SHAW RD. PUYALLUP, WA. Includes Robison Engineering, Inc. logo and contact info.

PERMIT SET 07/29/2025


SHEET TITLE: LEGEND, GENERAL NOTES, DRAWING INDEX

SHEET NO. E0.00

City of Puyallup Development & Permitting Services ISSUED PERMIT	
Building	Planning
Engineering	Public Works
Fire	Traffic

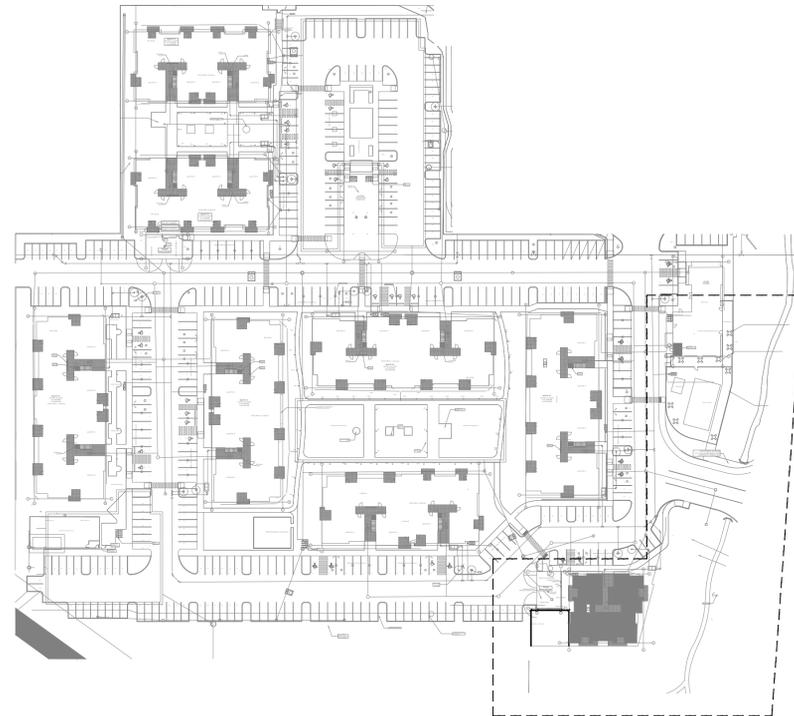


VICINITY MAP

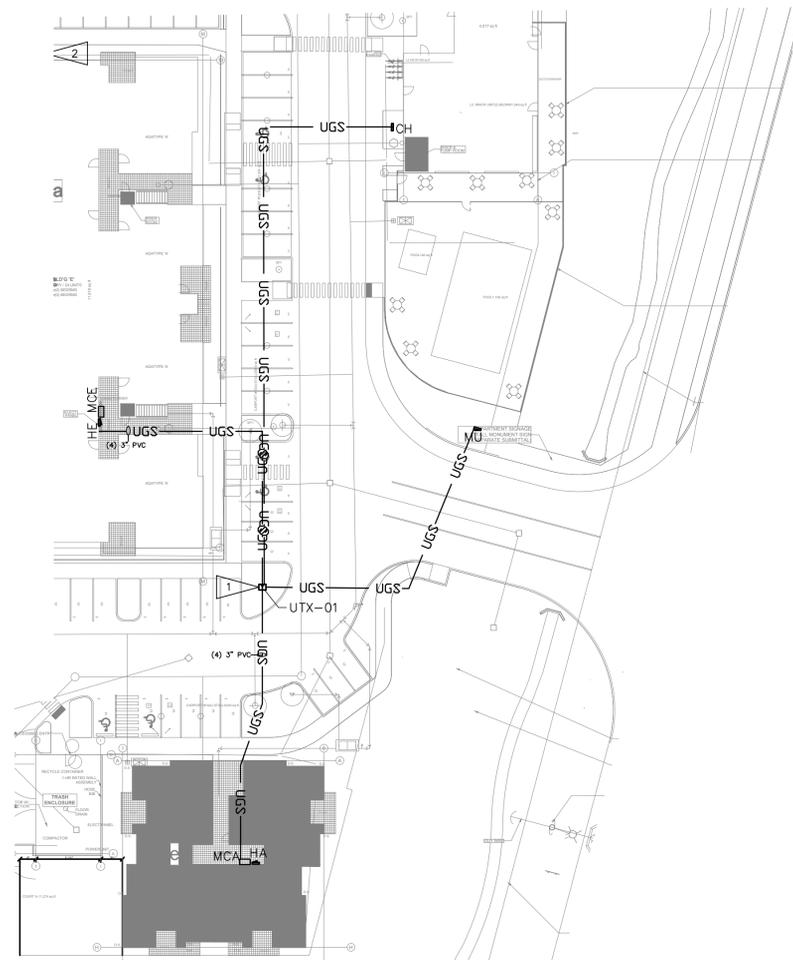

BUILDING A & CH SITE PLAN - POWER

SCALE: 1" = 30'

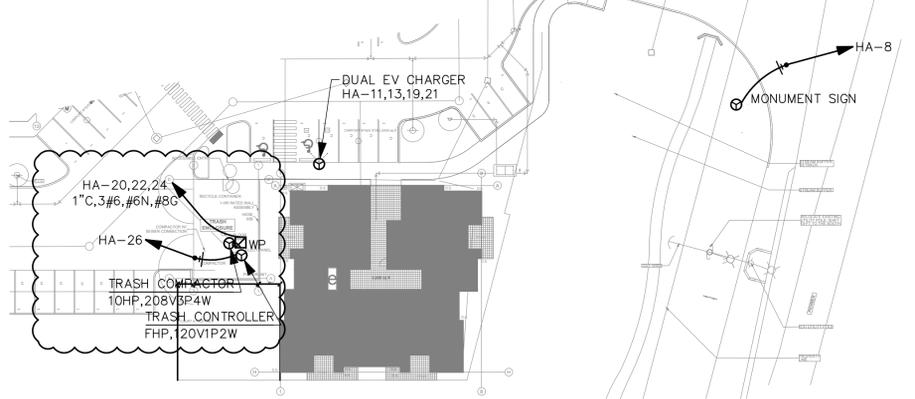

BUILDING A&CH SITE PLAN - EV & SOLAR LAYOUT

SCALE: 1" = 30'



NO.	DATE	DESCRIPTION
	12/31/24	PERMIT SET
	02/20/25	STREET LIGHTING REVISIONS
	04/22/25	PERMIT SET 3
	07/03/25	PERMIT SET 4



DRAWN: KAS
DESIGNED: KAS
CHECKED: STEINKE M.
APPROVED: STEINKE M.

PROJECT: EAST TOWN CROSSING BUILDING A
TENANT IMPROVEMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206-964-3343




DATE:
07-03-2025

SHEET TITLE:
SITE PLAN

SHEET NO.
E0.02

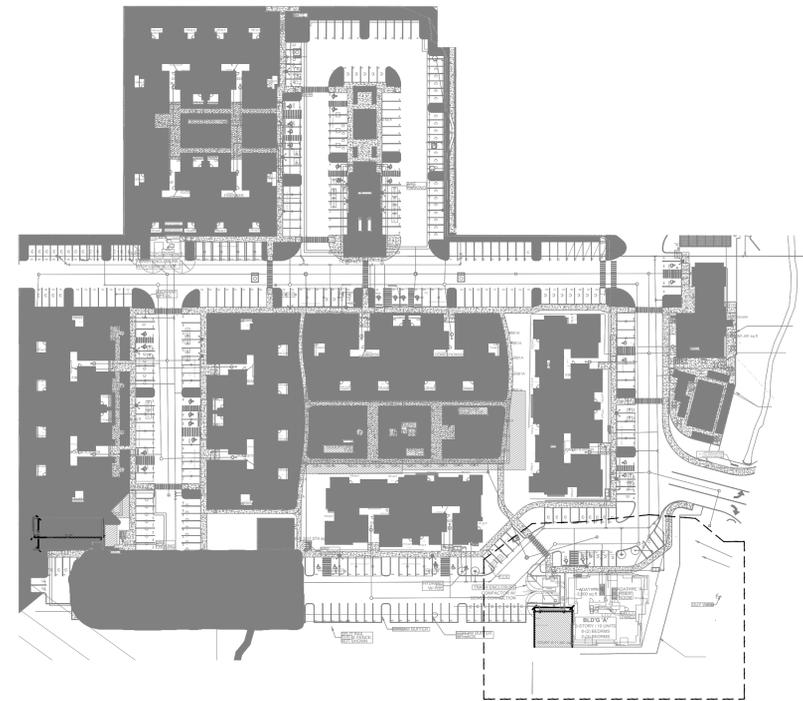

VICINITY MAP

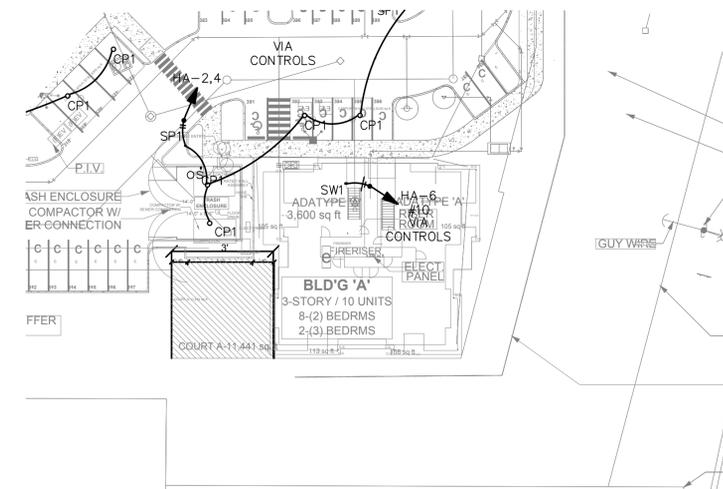

BUILDING A SITE LIGHTING PLAN – POWER

SCALE: 1" = 30'



BUILDING A

LIGHTING PLAN

EXTERIOR & SITE LUMINAIRE SCHEDULE

CALLOUT	SYMBOL	MOUNTING	DESCRIPTION	MODEL	VOLTAGE	TYPE	CRI / CCT	LAMPING	WATTAGE
CP1	○	SURFACE	CARPORT LIGHT - TYPE 5 - B1 U0 G1	GARDCO: SVPG A01 830 5CD [MOUNTING] UNV	MULTIPLE	0-10V DIMMING	80 / 3000K	(1) 21W LED	21
SB1	○	3' BOLLARD	BOLLARD - TYPE 5 - B1 U0 G0	GARDCO: PUREFORM BOLLARD / PBL 36 14L 100 WW-G2 5 UNV	MULTIPLE	0-10V DIMMING	70 / 3000K	(1) 6W LED	6
SB1A	⊕	3' BOLLARD	BOLLARD - TYPE 3 - B0 U0 G0	GARDCO: PUREFORM BOLLARD / PBL 36 14L 100 WW-G2 3 UNV	MULTIPLE	0-10V DIMMING	70 / 3000K	(1) 6W LED	6
SF1	⊕	SURFACE	MONUMENT SIGN FLOOD LIGHT	TBD	120	TBD		(1) 15W LED	15
SP1	○	16' POLE	POST TOP LIGHT - TYPE 5 - B2 U3 G2	WE-EF: ZFT434LED / 115-1283	MULTIPLE	0-10V DIMMING	80 / 3000K	(1) 42W LED	42
SP2	○	16' POLE	POLE LIGHT - SPORT COURT - B1 U0 G2 - TYPE 3	SIGNIFY - GARDCO: P15 P A03 730 T3M AR1 UNV PCB [FINISH]	MULTIPLE	0-10V DIMMING	80 / 3000K	(1) 45W LED	45
SU1	⊕	TREE BAND	UPLIGHT - ACCENT	HK LIGHTING: ZX1161 120V 5W 30K 010 / TMS120 TS - WATER TIGHT FITTING - CORD & PLUG BY ELECTRICAL	120	0-10V DIMMING		(1) 10W LED	10
SW1	⊕	SURFACE	EXTERIOR SCONCE - STAIRS - NB UP / TYPE II DOWN - MH 10'	PERFORMANCE IN LIGHTING: AMON / 070274	MULTIPLE	0-10V DIMMING	80 / 3000K	(1) 37W LED	37
SW2	⊕	SURFACE	SECURITY LIGHT - TRASH ENCLOSURES	STONCO: SL20 SCT G1 8 BK	MULTIPLE	INTEGRAL MOTION & PHOTOCELL	70 / 3000K	(1) 20W LED	20
WP1	⊕	SURFACE	WALL PACK - PARKING - TYPE III - B2 U0 G2 - MH 18'	GARDCO: PUREFORM COMFORT OPTICS / PWS 140L 1150 WW-G2 3 X UNV	MULTIPLE	AS NEEDED	70 / 3000K	(1) 52W LED	52
WP2	⊕	SURFACE	WALL PACK - POOL - TYPE IV - B3 U0 G3 - MH 14'	GARDCO: PUREFORM COMFORT OPTICS / PWS 140L 1675 WW-G2 4 UNV	MULTIPLE	AS NEEDED		(1) 76W LED	76

- CONTRACTOR TO FURNISH AND INSTALL ALL FIXTURES.
- FIXTURE FINISHES TO BE COORDINATED WITH ARCHITECT/ID.

DWELLING UNIT LUMINAIRE SCHEDULE

CALLOUT	SYMBOL	LAMP	MOUNTING	DESCRIPTION	MODEL	VOLTAGE	WATTAGE	NOTES
T1	⊕	(1)	CEILING	SURFACE MOUNT LED LIGHT	OSTW: OW-LFMDR-14D2130-NK	120V 1P 2W	21	
T2	⊕	(1)	CEILING	SURFACE MOUNT LED	OSTW: OW-LDS01-6D1530N	120V 1P 2W	15	
T3	○	(1)	CEILING	FAN/LIGHT COMBO	KICHLER: 330017NI	120V 1P 2W	52	PROVIDE DIVA: DVFSQ-LF CONTROLLER IN UNITS DESIGNATED AS ACCESSIBLE PER ARCHITECTUAL
T4	⊕	(1)	PENDANT	LED CHANDELIER	OSTW: OW-LSFDR-12D1530-NK	120V 1P 2W	15	
T5	●	(1)	CEILING	LAUNDRY LIGHT/HOUSE FAN COMBO	BROAN: LP50100DC	120V 1P 2W	45	
T6	●	(1)	CEILING	BATH FAN/LIGHT COMBO	ORB: OSP70L	120V 1P 2W	45	
T7	⊕	(1)	WALL	LED VANITY LIGHT	KICHLER: 5337NIS	120V 1P 2W	27	(3) BULBRITE 9W LED BULBS: ITEM #774006
T8	⊕	(1)	WALL	EXT. LED SCONCE		120V 1P 2W	20	
T9	○	(1)	CEILING	SURFACE MOUNT LED	OSTW: OW-LDS0B-6D1830W	120V 1P 2W	18	
T13	□	(1)	CEILING	1.4 LED TROFFER	TBD	120V 1P 2W	40	

- CONTRACTOR TO FURNISH AND INSTALL ALL FIXTURES.
- FIXTURE FINISHES TO BE COORDINATED WITH ARCHITECT/ID.

GENERAL LIGHTING NOTES

PRGA20250487

- LIGHTING CONTROLS SHALL BE INSTALLED WHICH MEET ALL REQUIREMENTS OF LOCAL ENERGY CODES.
- EMERGENCY LIGHT FIXTURES: PROVIDE UNSWITCHED HOT FOR BATTERY CHARGER.
- LOCATIONS OF OCCUPANCY SENSORS, PHOTO SENSORS, DIMMERS, AND SWITCHES ARE DIAGRAMMATIC. CONTRACTOR TO FIELD-IDENTIFY OPTIMAL LOCATIONS AND QUANTITIES.
- ASSURE COMPATIBILITY OF DIMMERS WITH CONTROLLED LUMINAIRES PRIOR TO PURCHASING.
- AUTOMATIC LIGHTING SHUT-OFF CONTROLS SHALL BE PROVIDED BY LOCAL OCCUPANCY SENSORS AND/OR ASTRONOMIC TIME CLOCK UNLESS OTHERWISE NOTED.
- DAYLIGHT ZONES ARE REFERRED TO AS 'PRIMARY' AND 'SECONDARY' ON PLANS AND DENOTED BY DASHED LINES.
- FOR CUSTOM FF&E FIXTURES, IT IS THE MANUFACTURER'S RESPONSIBILITY TO FURNISH PRODUCTS WHICH ARE COMPLIANT WITH ALL REQUIREMENTS OF LOCAL ENERGY CODES, AS WELL AS MATCH THE ELECTRICAL SPECIFICATIONS PROVIDED IN THE LUMINAIRE SCHEDULES. PROVIDE SUBMITTAL SHOP DRAWINGS WITHIN 30 DAYS OF RECEIVING FIXTURE ORDER. SUBMITTALS SHALL CLEARLY INDICATE LAMPING AND MAXIMUM WATTAGE RATING OF LAMP SOCKETS. NON-COMPLIANT FIXTURES REJECTED BY ELECTRICAL INSPECTOR SHALL BE RETURNED TO THE MANUFACTURER FOR REWORKING AND/OR RE-LABELING.
- EMERGENCY EGRESS LIGHTING TO BE CONFIRMED AS INTENDED EGRESS DESIGN PRIOR TO PERMITTING

EXIT SIGN NOTES

DURING CONSTRUCTION, UPON COMPLETION OF A TYPICAL FLOOR FRAMING AND BEFORE WALL COVER, ELECTRICAL CONTRACTOR SHALL WALK THE EGRESS PATHS WITH THE LOCAL INSPECTOR (AHJ) TO CONFIRM THAT ALL THE EXIT SIGNS ARE LOCATED PER THE AHJ'S SATISFACTION AND IDENTIFY ANY ADDITIONAL EXIT SIGNS THAT THE AHJ WISHES TO BE INSTALLED. CONTRACTOR SHALL INCLUDE IN THEIR BASE BID UP TO 10% ADDITIONAL EXIT SIGNS (HIGH & LOW) AT NO ADDITIONAL COST. INCLUDE COST OF FIXTURES AND ASSOCIATED WIRING AND INSTALLATION.

LIGHTING CONTROL SYSTEM REQUIREMENTS

- CONTRACTOR TO PROVIDE A FULLY OPERATIONAL LIGHTING CONTROL SYSTEM.
- ELECTRICAL CONTRACTOR SHALL COORDINATE WITH A LIGHTING CONTROLS VENDOR TO OBTAIN LIGHTING CONTROL SYSTEM PACKAGE COMPLETE WITH DEVICES, WIRING DIAGRAMS, ANNOTATED PLANS INDICATING WHICH DEVICE TO BE USED IN EACH LOCATION, CONNECTION REQUIREMENTS, SET UP INSTRUCTIONS, COMMISSIONING AND CHECK-OUT FOLLOWING COMPLETION. PROVIDE ALL LOW VOLTAGE WIRING AS REQUIRED FOR CONTROL DEVICE INTERCONNECTIONS.
- INSTALLER QUALIFICATIONS: TECHNICIAN INSTALLING AND WIRING THE LIGHTING CONTROL SYSTEM SHALL HAVE INSTALLED THIS SAME SYSTEM AT LEAST ONCE PREVIOUSLY. TECHNICIAN SHALL HAVE RECEIVED TRAINING BY FACTORY REPRESENTATIVE ON THE SYSTEM BEING INSTALLED.
- PROVIDE LIGHTING CONTROL SYSTEM TO PERFORM THE FUNCTIONS DESCRIBED BELOW AND WHERE INDICATED ON PLANS. NOT ALL FEATURES ARE REQUIRED.
 - CONTROL EXTERIOR LIGHTING BASED ON ASTRONOMIC TIME-CLOCK SCHEDULING.
 - INTERIOR PRIMARY AND SECONDARY DAYLIGHT HARVESTING CONTROL PER ENERGY CODE REQUIREMENTS.
 - PROVIDE SEPARATE SWITCHING AND DIMMING CONTROL FOR LIGHTING ZONES AS INDICATED IN LIGHTING DIMMING SCHEDULE.
- DURING EMERGENCY CONDITIONS EMERGENCY LIGHTING CIRCUITS SHALL BYPASS ALL LIGHTING CONTROLS IN ORDER TO ENERGIZE ALL CONNECTED LUMINAIRES AT FULL CAPACITY. PROVIDE UL924 RELAYS AS REQUIRED TO BYPASS AREA CONTROLS.

LIGHTING CONTROLS LEGEND

⊕ ⊕	TOGGLE SWITCH FOR MANUAL ON/OFF LIGHTING CONTROL. SUBSCRIPT INDICATES WHICH FIXTURES ARE TO BE CONTROLLED BY WHICH SWITCH.
⊕ ⊕	DIMMER SWITCH FOR MANUAL MULTI-LEVEL LIGHTING CONTROL. SWITCH SHALL ALSO HAVE MANUAL ON/OFF FUNCTIONALITY. SUBSCRIPT INDICATES WHICH FIXTURES ARE TO BE CONTROLLED BY WHICH DIMMER.
OS OS	SWITCHES LABELED 'OS' SHALL TURN OFF ALL CONNECTED LUMINAIRES WITHIN 30 MINUTES OF SPACE BEING VACANT.
⊕	OCCUPANCY SENSOR SHALL AUTOMATICALLY TURN OFF ALL CONNECTED LUMINAIRES WITHIN 30 MINUTES OF SPACE BEING VACANT.
⊕	PHOTOSENSOR FOR DAYLIGHT ZONE CONTROL SHALL AUTOMATICALLY ADJUST THE LIGHT OUTPUT OF ALL CONNECTED LUMINAIRES BASED ON THE DAYLIGHT LEVEL IN THE SPACE.



REVISIONS	DESCRIPTION
NO.	DATE



DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: **EAST TOWN CROSSING BUILDING A**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-848-6119

ROBISON ENGINEERING, INC

PERMIT SET
 07/29/2025


SHEET TITLE:
LIGHTING NOTES & LUMINAIRE SCHEDULE

SHEET NO.
 E1.50

City of Puyallup Development & Permitting Services ISSUED PERMIT	
Building	Planning
Engineering	Public Works
Fire	Traffic

SHEET NOTES:

1. PROVIDE CONDUITS WITH PULL WIRE FROM DEMARCATION OR MDF TO IDF CLOSETS FOR ALL SYSTEMS INCLUDING VOICE, DATA, TV AND SECURITY. QUANTITY AND SIZE AS DETERMINED BY LOW VOLTAGE CONSULTANT. PROVIDE SLEEVES WITH BUSHINGS AT BOTH ENDS PER LOW VOLTAGE CONSULTANT. FIRE STOP AS REQUIRED BY AHJ
2. PROVIDE CONDUIT, WIRING, CIRCUITS AND CONNECTIONS AS COORDINATED WITH SECURITY VENDOR FOR FULLY FUNCTIONING SECURITY AND ACCESS CONTROL SYSTEM. COORDINATE WITH SECURITY CONSTRUCTION DOCUMENTS TO IDENTIFY ALL CAMERA LOCATIONS, AT ALL DOORS CALLED OUT BY OWNER, AS WELL AS ROLL UP GARAGE DOORS FOR GARAGE ACCESS.
3. AMENITY SPACES, OFFICES AND PUBLIC AREAS: ROUGH-IN FOR EQUIPMENT, OUTLETS AND APPLIANCES IN AMENITY SPACES TO BE COORDINATED WITH ARCHITECT. REFER TO ARCHITECTS DRAWINGS AND ELEVATIONS.
4. WIRING METHOD FOR APARTMENT FEEDERS MUST BE SUITABLE FOR THE TYPE OF CONSTRUCTION. SEE NEC 334.10
5. CONTRACTOR TO COORDINATE DOOR CONTROLS AND CONNECTIONS WITH DOOR VENDOR. PROVIDE RACEWAY, CONDUCTORS, POWER SUPPLY AND TERMINATIONS FOR A FULLY FUNCTIONING SYSTEM. COORDINATE WITH SECURITY VENDOR FOR MONITORING AND CONTROL AS NEEDED.
6. ELECTRICAL CONTRACTOR (EC) TO PROVIDE J-BOX/PULL BOX SO NUMBER OF BENDS IN CONDUIT DOES NOT EXCEED CODE REQUIREMENT (360 MAX TOTAL). EC TO FIELD VERIFY LOCATION OF J-BOX/PULL BOX. COORDINATE WITH ARCHITECT WHERE ACCESS PANEL IS REQUIRED.
7. PROVIDE BLOCKOUTS AND SLEEVES AS REQUIRED FOR ALL FEEDERS AND RISERS SHOWN ON 1-LINE. COORDINATE WITH STRUCTURAL. PROVIDE SUPPORT FOR VERTICAL FEEDERS AS REQUIRED BY NEC 300.19. ANY SLEEVE LOCATIONS SHOWN ARE DIAGRAMMATIC ONLY. ELECTRICAL PLANS DO NOT SHOW BRANCH CIRCUIT OR SMALL FEEDER CONDUIT RUNS. LAYOUT PER EC. FINAL VERIFICATION OF NUMBER AND LOCATION OF ALL FLOOR PENETRATIONS BY EC.

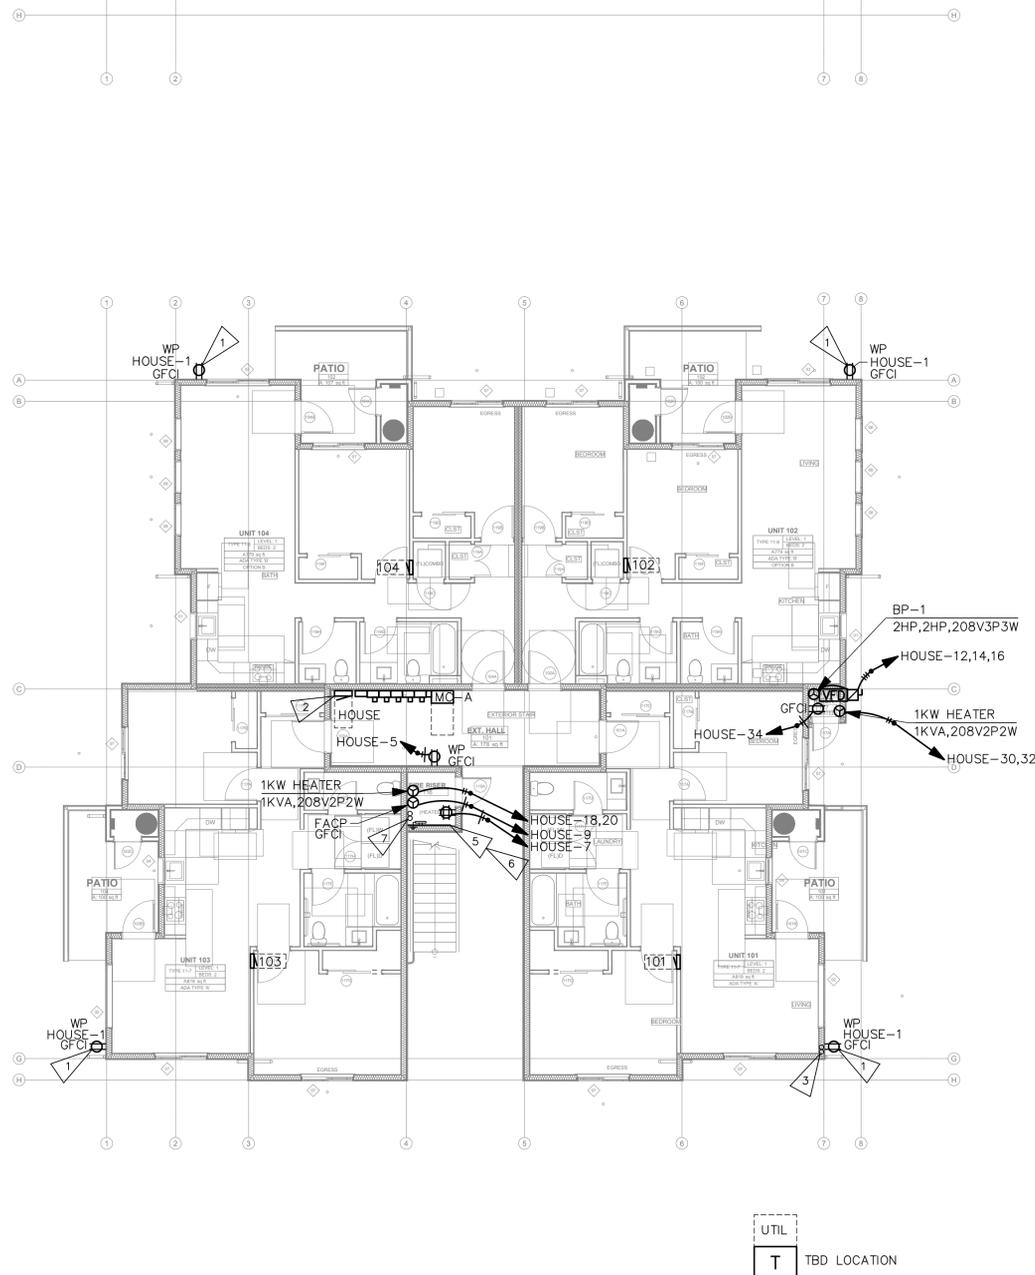

FLAG NOTES: (NOT EVERY FLAG IS USED ON EVERY SHEET)

1. PROVIDE LOCKING COVER FOR EXTERIOR & CORRIDOR RECEPTACLES. TYP.
2. LEAVE 2' OF OPEN WALL SPACE ADJACENT TO HOUSE PANEL FOR FUTURE EV PANEL.
3. PROVIDE (1) 2" CONDUIT FROM TELEPHONE VAULT AND (1) 2" CONDUIT FROM THE CABLE TV VAULT. COORDINATE WITH TELECOM UTILITY FOR TELEPHONE & CABLE TV VAULT LOCATIONS.
4. MECHANICAL EQUIPMENT ON ROOF POWERED FROM INDIVIDUAL TENANT SPACES. COORDINATE LOCATION WITH MECHANICAL DRAWINGS.
5. PROVIDE 4'X8'X3/4" FIRE RETARDANT PLYWOOD. BOTTOM 6" AFF TOP OF PLYWOOD 102" AFF.
6. PROVIDE COPPER GROUND BAR 2"X24"X1/4" AND #6 COPPER GROUND WIRE TO MAIN SERVICE GROUND.
7. PROVIDE (2) 4" SLEEVES FOR LV CABLE TO COMM/DATA UTILITIES. COORDINATE RISER LOCATION WITH ARCHITECT.

REVISIONS	DESCRIPTION	DATE	NO.



DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: **EAST TOWN CROSSING BUILDING A**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-834-3118

PERMIT SET
 07/29/2025

SHEET TITLE:
POWER PLAN
 - LEVEL 2

SHEET NO.
 E3.00




SHEET NOTES:

1. PROVIDE CONDUITS WITH PULL WIRE FROM DEMARCATION OR MDF TO IDF CLOSETS FOR ALL SYSTEMS INCLUDING VOICE, DATA, TV AND SECURITY. QUANTITY AND SIZE AS DETERMINED BY LOW VOLTAGE CONSULTANT. PROVIDE SLEEVES WITH BUSHINGS AT BOTH ENDS PER LOW VOLTAGE CONSULTANT. FIRE STOP AS REQUIRED BY AHJ
2. PROVIDE CONDUIT, WIRING, CIRCUITS AND CONNECTIONS AS COORDINATED WITH SECURITY VENDOR FOR FULLY FUNCTIONING SECURITY AND ACCESS CONTROL SYSTEM. COORDINATE WITH SECURITY CONSTRUCTION DOCUMENTS TO IDENTIFY ALL CAMERA LOCATIONS, AT ALL DOORS CALLED OUT BY OWNER, AS WELL AS ROLL UP GARAGE DOORS FOR GARAGE ACCESS.
3. AMENITY SPACES, OFFICES AND PUBLIC AREAS: ROUGH-IN FOR EQUIPMENT, OUTLETS AND APPLIANCES IN AMENITY SPACES TO BE COORDINATED WITH ARCHITECT. REFER TO ARCHITECTS DRAWINGS AND ELEVATIONS.
4. WIRING METHOD FOR APARTMENT FEEDERS MUST BE SUITABLE FOR THE TYPE OF CONSTRUCTION. SEE NEC 334.10
5. CONTRACTOR TO COORDINATE DOOR CONTROLS AND CONNECTIONS WITH DOOR VENDOR. PROVIDE RACEWAY, CONDUCTORS, POWER SUPPLY AND TERMINATIONS FOR A FULLY FUNCTIONING SYSTEM. COORDINATE WITH SECURITY VENDOR FOR MONITORING AND CONTROL AS NEEDED.
6. ELECTRICAL CONTRACTOR (EC) TO PROVIDE J-BOX/PULL BOX SO NUMBER OF BENDS IN CONDUIT DOES NOT EXCEED CODE REQUIREMENT (360 MAX TOTAL). EC TO FIELD VERIFY LOCATION OF J-BOX/PULL BOX. COORDINATE WITH ARCHITECT WHERE ACCESS PANEL IS REQUIRED.
7. PROVIDE BLOCKOUTS AND SLEEVES AS REQUIRED FOR ALL FEEDERS AND RISERS SHOWN ON 1-LINE. COORDINATE WITH STRUCTURAL. PROVIDE SUPPORT FOR VERTICAL FEEDERS AS REQUIRED BY NEC 300.19. ANY SLEEVE LOCATIONS SHOWN ARE DIAGRAMMATIC ONLY. ELECTRICAL PLANS DO NOT SHOW BRANCH CIRCUIT OR SMALL FEEDER CONDUIT RUNS. LAYOUT PER EC. FINAL VERIFICATION OF NUMBER AND LOCATION OF ALL FLOOR PENETRATIONS BY EC.

FLAG NOTES: (NOT EVERY FLAG IS USED ON EVERY SHEET)

1. PROVIDE LOCKING COVER FOR EXTERIOR & CORRIDOR RECEPTACLES. TYP.
2. LEAVE 2' OF OPEN WALL SPACE ADJACENT TO HOUSE PANEL FOR FUTURE EV PANEL.
3. PROVIDE (1) 2" CONDUIT FROM TELEPHONE VAULT AND (1) 2" CONDUIT FROM THE CABLE TV VAULT. COORDINATE WITH TELECOM UTILITY FOR TELEPHONE & CABLE TV VAULT LOCATIONS.
4. MECHANICAL EQUIPMENT ON ROOF POWERED FROM INDIVIDUAL TENANT SPACES. COORDINATE LOCATION WITH MECHANICAL DRAWINGS.
5. PROVIDE 4'X8'X3/4" FIRE RETARDANT PLYWOOD. BOTTOM 6" AFF TOP OF PLYWOOD 102" AFF.
6. PROVIDE COPPER GROUND BAR 2"X24"X1/4" AND #6 COPPER GROUND WIRE TO MAIN SERVICE GROUND.
7. PROVIDE (2) 4" SLEEVES FOR LV CABLE TO COMM/DATA UTILITIES. COORDINATE RISER LOCATION WITH ARCHITECT.

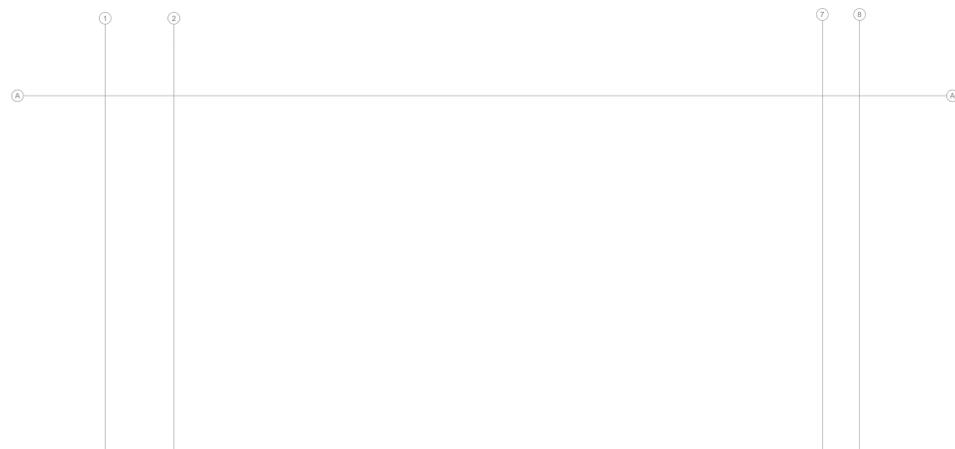

POWER PLAN — LEVEL 2

SCALE: 1/8" = 1'-0" 0' 4' 8' 16'



REVISIONS	DESCRIPTION
NO.	DATE



DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: **EAST TOWN CROSSING BUILDING A**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-834-3161

PERMIT SET
 07/29/2025


SHEET TITLE:
POWER PLAN
 — LEVEL 3

SHEET NO.
 E3.01



SHEET NOTES:

1. PROVIDE CONDUITS WITH PULL WIRE FROM DEMARCATION OR MDF TO IDF CLOSETS FOR ALL SYSTEMS INCLUDING VOICE, DATA, TV AND SECURITY. QUANTITY AND SIZE AS DETERMINED BY LOW VOLTAGE CONSULTANT. PROVIDE SLEEVES WITH BUSHINGS AT BOTH ENDS PER LOW VOLTAGE CONSULTANT. FIRE STOP AS REQUIRED BY AHJ
2. PROVIDE CONDUIT, WIRING, CIRCUITS AND CONNECTIONS AS COORDINATED WITH SECURITY VENDOR FOR FULLY FUNCTIONING SECURITY AND ACCESS CONTROL SYSTEM. COORDINATE WITH SECURITY CONSTRUCTION DOCUMENTS TO IDENTIFY ALL CAMERA LOCATIONS, AT ALL DOORS CALLED OUT BY OWNER, AS WELL AS ROLL UP GARAGE DOORS FOR GARAGE ACCESS.
3. AMENITY SPACES, OFFICES AND PUBLIC AREAS: ROUGH-IN FOR EQUIPMENT, OUTLETS AND APPLIANCES IN AMENITY SPACES TO BE COORDINATED WITH ARCHITECT. REFER TO ARCHITECTS DRAWINGS AND ELEVATIONS.
4. WIRING METHOD FOR APARTMENT FEEDERS MUST BE SUITABLE FOR THE TYPE OF CONSTRUCTION. SEE NEC 334.10
5. CONTRACTOR TO COORDINATE DOOR CONTROLS AND CONNECTIONS WITH DOOR VENDOR. PROVIDE RACEWAY, CONDUCTORS, POWER SUPPLY AND TERMINATIONS FOR A FULLY FUNCTIONING SYSTEM. COORDINATE WITH SECURITY VENDOR FOR MONITORING AND CONTROL AS NEEDED.
6. ELECTRICAL CONTRACTOR (EC) TO PROVIDE J-BOX/PULL BOX SO NUMBER OF BENDS IN CONDUIT DOES NOT EXCEED CODE REQUIREMENT (360 MAX TOTAL). EC TO FIELD VERIFY LOCATION OF J-BOX/PULL BOX. COORDINATE WITH ARCHITECT WHERE ACCESS PANEL IS REQUIRED.
7. PROVIDE BLOCKOUTS AND SLEEVES AS REQUIRED FOR ALL FEEDERS AND RISERS SHOWN ON 1-LINE. COORDINATE WITH STRUCTURAL. PROVIDE SUPPORT FOR VERTICAL FEEDERS AS REQUIRED BY NEC 300.19. ANY SLEEVE LOCATIONS SHOWN ARE DIAGRAMMATIC ONLY. ELECTRICAL PLANS DO NOT SHOW BRANCH CIRCUIT OR SMALL FEEDER CONDUIT RUNS. LAYOUT PER EC. FINAL VERIFICATION OF NUMBER AND LOCATION OF ALL FLOOR PENETRATIONS BY EC.

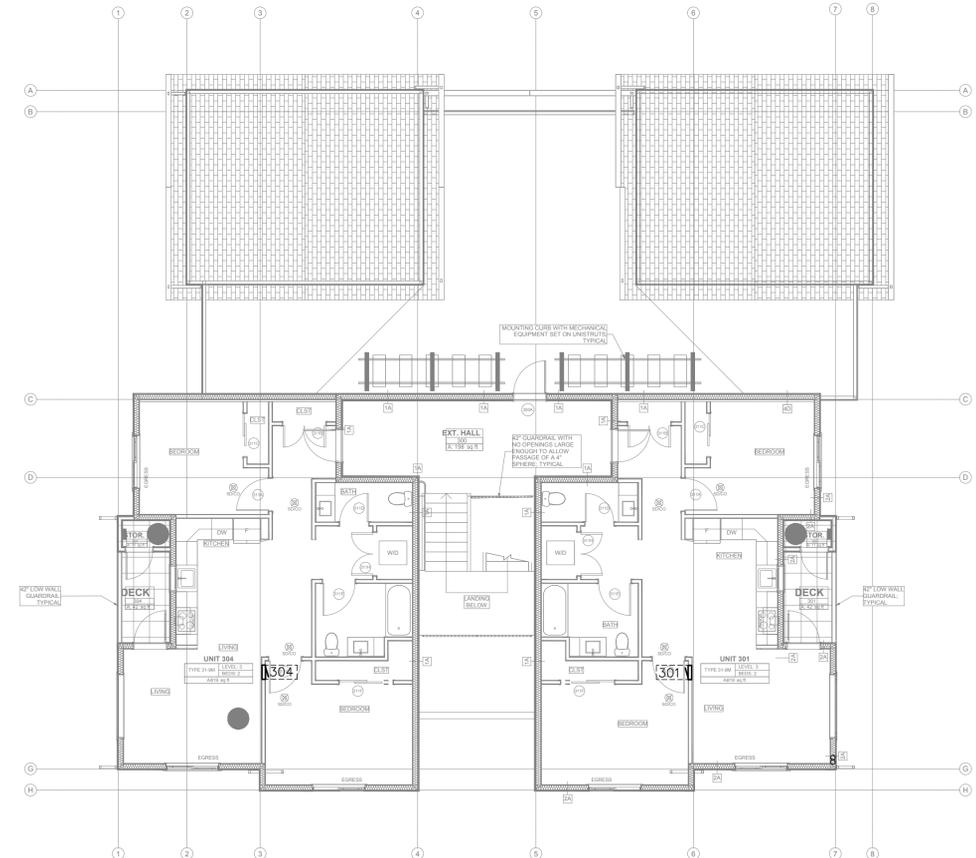

FLAG NOTES:

(NOT EVERY FLAG IS USED ON EVERY SHEET)

1. PROVIDE LOCKING COVER FOR EXTERIOR & CORRIDOR RECEPTACLES. TYP.
2. LEAVE 2' OF OPEN WALL SPACE ADJACENT TO HOUSE PANEL FOR FUTURE EV PANEL.
3. PROVIDE (1) 2" CONDUIT FROM TELEPHONE VAULT AND (1) 2" CONDUIT FROM THE CABLE TV VAULT. COORDINATE WITH TELECOM UTILITY FOR TELEPHONE & CABLE TV VAULT LOCATIONS.
4. MECHANICAL EQUIPMENT ON ROOF POWERED FROM INDIVIDUAL TENANT SPACES. COORDINATE LOCATION WITH MECHANICAL DRAWINGS.
5. PROVIDE 4'X8'X3/4" FIRE RETARDANT PLYWOOD. BOTTOM 6" AFF TOP OF PLYWOOD 102" AFF.
6. PROVIDE COPPER GROUND BAR 2"X24"X1/4" AND #6 COPPER GROUND WIRE TO MAIN SERVICE GROUND.
7. PROVIDE (2) 4" SLEEVES FOR LV CABLE TO COMM/DATA UTILITIES. COORDINATE RISER LOCATION WITH ARCHITECT.

NO.	DATE	DESCRIPTION



DRAWN:	LYSAK K.
DESIGNED:	LYSAK K.
CHECKED:	STEINKE M.
APPROVED:	STEINKE M.

PROJECT: **EAST TOWN CROSSING BUILDING A**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA


19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-848-5362

ROBISON ENGINEERING, INC.

PERMIT SET
07/29/2025

SHEET TITLE:
POWER PLAN
- LEVEL 4

SHEET NO.
E3.02

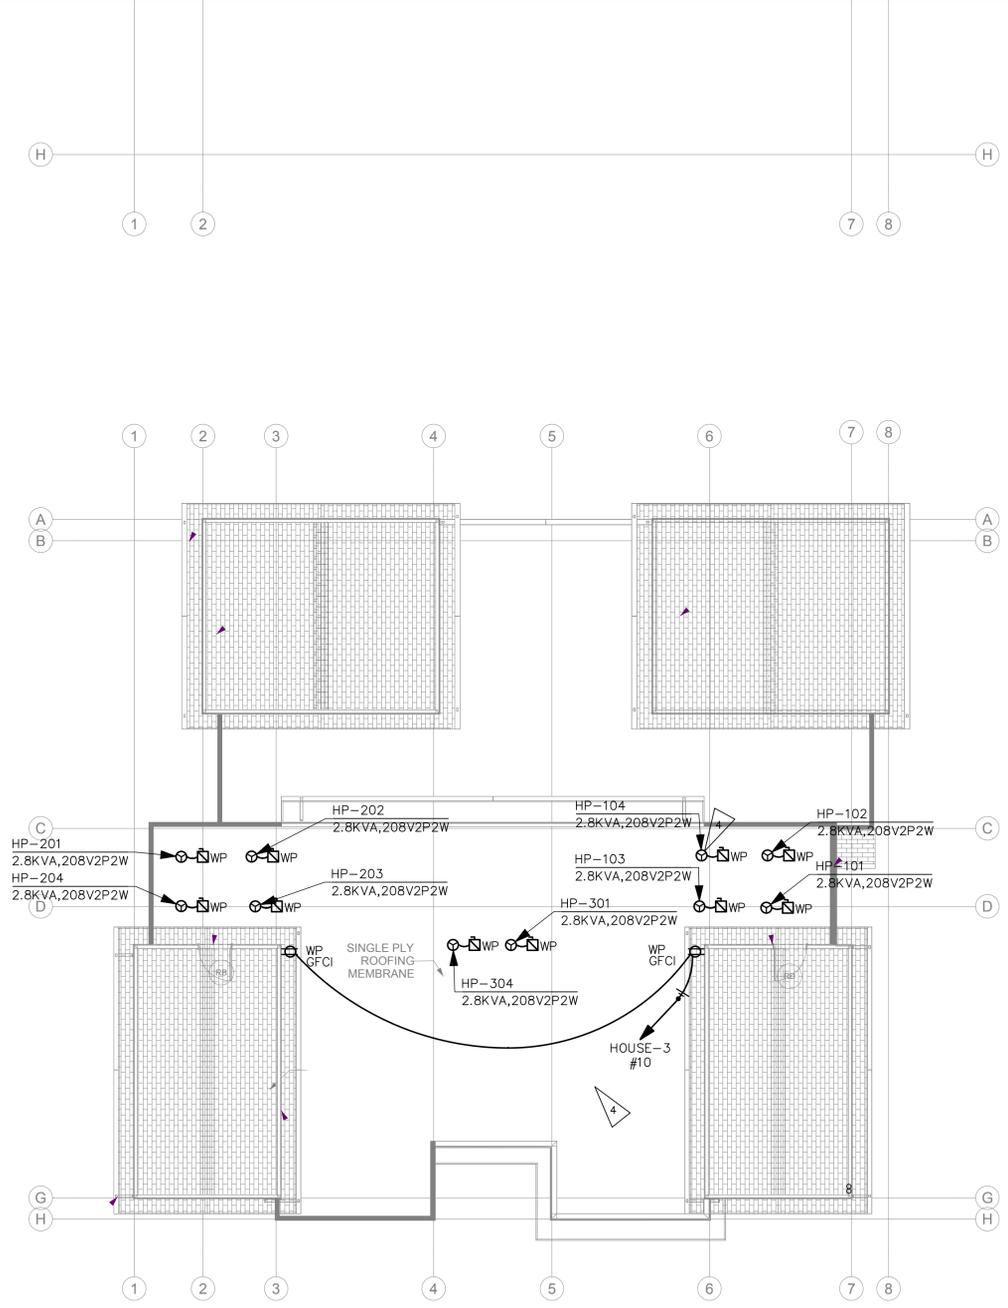

SHEET NOTES:

1. PROVIDE CONDUITS WITH PULL WIRE FROM DEMARCATION OR MDF TO IDF CLOSETS FOR ALL SYSTEMS INCLUDING VOICE, DATA, TV AND SECURITY. QUANTITY AND SIZE AS DETERMINED BY LOW VOLTAGE CONSULTANT. PROVIDE SLEEVES WITH BUSHINGS AT BOTH ENDS PER LOW VOLTAGE CONSULTANT. FIRE STOP AS REQUIRED BY AHJ
2. PROVIDE CONDUIT, WIRING, CIRCUITS AND CONNECTIONS AS COORDINATED WITH SECURITY VENDOR FOR FULLY FUNCTIONING SECURITY AND ACCESS CONTROL SYSTEM. COORDINATE WITH SECURITY CONSTRUCTION DOCUMENTS TO IDENTIFY ALL CAMERA LOCATIONS, AT ALL DOORS CALLED OUT BY OWNER, AS WELL AS ROLL UP GARAGE DOORS FOR GARAGE ACCESS.
3. AMENITY SPACES, OFFICES AND PUBLIC AREAS: ROUGH-IN FOR EQUIPMENT, OUTLETS AND APPLIANCES IN AMENITY SPACES TO BE COORDINATED WITH ARCHITECT. REFER TO ARCHITECTS DRAWINGS AND ELEVATIONS.
4. WIRING METHOD FOR APARTMENT FEEDERS MUST BE SUITABLE FOR THE TYPE OF CONSTRUCTION. SEE NEC 334.10
5. CONTRACTOR TO COORDINATE DOOR CONTROLS AND CONNECTIONS WITH DOOR VENDOR. PROVIDE RACEWAY, CONDUCTORS, POWER SUPPLY AND TERMINATIONS FOR A FULLY FUNCTIONING SYSTEM. COORDINATE WITH SECURITY VENDOR FOR MONITORING AND CONTROL AS NEEDED.
6. ELECTRICAL CONTRACTOR (EC) TO PROVIDE J-BOX/PULL BOX SO NUMBER OF BENDS IN CONDUIT DOES NOT EXCEED CODE REQUIREMENT (360 MAX TOTAL). EC TO FIELD VERIFY LOCATION OF J-BOX/PULL BOX. COORDINATE WITH ARCHITECT WHERE ACCESS PANEL IS REQUIRED.
7. PROVIDE BLOCKOUTS AND SLEEVES AS REQUIRED FOR ALL FEEDERS AND RISERS SHOWN ON 1-LINE. COORDINATE WITH STRUCTURAL. PROVIDE SUPPORT FOR VERTICAL FEEDERS AS REQUIRED BY NEC 300.19. ANY SLEEVE LOCATIONS SHOWN ARE DIAGRAMMATIC ONLY. ELECTRICAL PLANS DO NOT SHOW BRANCH CIRCUIT OR SMALL FEEDER CONDUIT RUNS. LAYOUT PER EC. FINAL VERIFICATION OF NUMBER AND LOCATION OF ALL FLOOR PENETRATIONS BY EC.

FLAG NOTES:

(NOT EVERY FLAG IS USED ON EVERY SHEET)

1. PROVIDE LOCKING COVER FOR EXTERIOR & CORRIDOR RECEPTACLES. TYP.
2. LEAVE 2' OF OPEN WALL SPACE ADJACENT TO HOUSE PANEL FOR FUTURE EV PANEL.
3. PROVIDE (1) 2" CONDUIT FROM TELEPHONE VAULT AND (1) 2" CONDUIT FROM THE CABLE TV VAULT. COORDINATE WITH TELECOM UTILITY FOR TELEPHONE & CABLE TV VAULT LOCATIONS.
4. MECHANICAL EQUIPMENT ON ROOF POWERED FROM INDIVIDUAL TENANT SPACES. COORDINATE LOCATION WITH MECHANICAL DRAWINGS.
5. PROVIDE 4'X8'X3/4" FIRE RETARDANT PLYWOOD. BOTTOM 6" AFF TOP OF PLYWOOD 102" AFF.
6. PROVIDE COPPER GROUND BAR 2"X24"X1/4" AND #6 COPPER GROUND WIRE TO MAIN SERVICE GROUND.
7. PROVIDE (2) 4" SLEEVES FOR LV CABLE TO COMM/DATA UTILITIES. COORDINATE RISER LOCATION WITH ARCHITECT.

REVISIONS	DESCRIPTION	DATE	NO.



DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: **EAST TOWN CROSSING BUILDING A**
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-864-3343


PERMIT SET
 07/29/2025

SHEET TITLE:
**POWER PLAN
 - ROOF**

SHEET NO.
 E3.03

POWER PLAN - ROOF

SCALE: 1/8" = 1'-0" 0' 4' 8' 16'

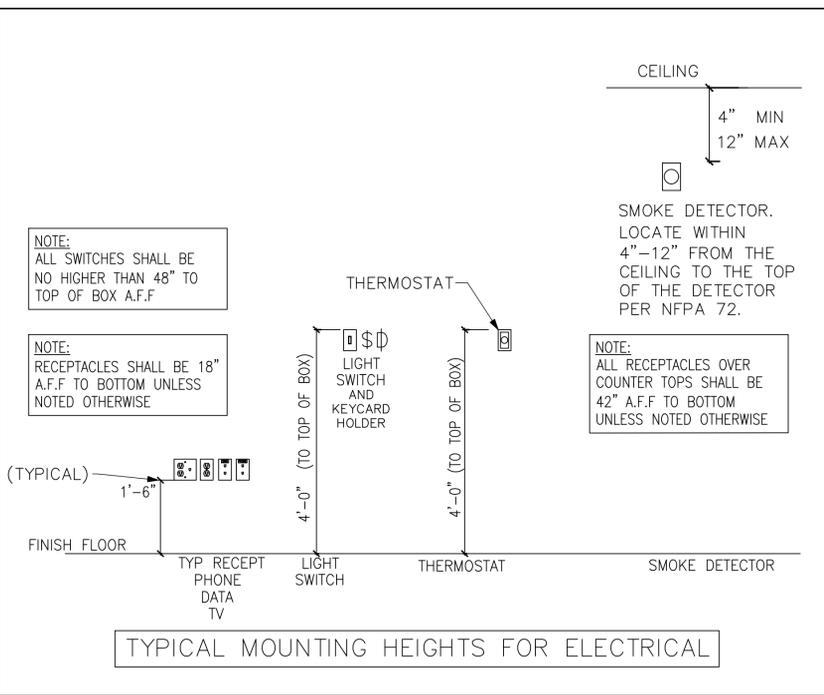


APARTMENT ELECTRICAL DEVICE SCHEDULE

SYMBOL	DEVICE	NOTES
⊕	RECEPTACLE, SIMPLEX	PROVIDE WHERE INDICATED.
⊕	RECEPTACLE, SIMPLEX, FLOOR MOUNT	PROVIDE WHERE INDICATED.
⊕	RECEPTACLE, DUPLEX, FLOOR MOUNT	PROVIDE WHERE INDICATED.
⊕	RECEPTACLE, DUPLEX	PROVIDE WHERE INDICATED.
⊕	RECEPTACLE, DUPLEX, SPLIT-WIRED	PROVIDE WHERE INDICATED. LOWER OUTLET CONTROLLED BY WALL SWITCH
⊕	RECEPTACLE, QUAD + TELEVISION CABLE OUTLET	PROVIDE WHERE INDICATED.
⊕	RECEPTACLE, QUAD	PROVIDE WHERE INDICATED.
▽	TELEPHONE WALL OUTLET	REFER TO LOW VOLTAGE PLANS
▽	COMM/DATA WALL OUTLET	REFER TO LOW VOLTAGE PLANS
⊕	TELEVISION CABLE OUTLET	REFER TO LOW VOLTAGE PLANS
\$	WALL SWITCH	PROVIDE WHERE INDICATED.
\$vs	WALL SWITCH VACANCY SENSOR	PROVIDE WHERE INDICATED.
\$SW	WALL SWITCH (3-WAY)	PROVIDE WHERE INDICATED.
⊕	WALL SWITCH DIMMER	PROVIDE WHERE INDICATED.
⊕	FAN CONTROL	PROVIDE WHERE INDICATED.
\$AT	SWITCH ASTRONOMICAL TIME CLOCK CONTROL	PROVIDE WHERE INDICATED.
⊕	LIGHT FIXTURE, WALL MOUNTED SCNCE	PROVIDE ROUGH IN WHERE INDICATED REFER TO LUMINAIRE SCHEDULE
⊕	LIGHT FIXTURE, CEILING MOUNTED	PROVIDE ROUGH IN WHERE INDICATED REFER TO LUMINAIRE SCHEDULE
⊕	PENDANT LIGHT FIXTURE, CEILING MOUNTED	PROVIDE ROUGH IN WHERE INDICATED REFER TO LUMINAIRE SCHEDULE
⊕	LIGHT FIXTURE, WALL MOUNTED	PROVIDE ROUGH IN WHERE INDICATED REFER TO LUMINAIRE SCHEDULE
⊕EF	FAN, CEILING MOUNTED.	FURNISHED & INSTALLED BY MECH, WIRED BY ELECTRICAL CONTRACTOR
⊕	THERMOSTAT	FURNISHED & INSTALLED BY MECH
⊕	SMOKE DETECTOR & CARBON MONOXIDE DETECTOR	PART OF DESIGN/BUILD FIRE ALARM SYSTEM. SMOKE/CO DETECTORS TO BE WIRED TO FIRE ALARM SYSTEM.
⊕DB	DOOR BELL BUTTON	PROVIDE WHERE INDICATED.
⊕DBC	DOOR BELL CHIMES	PROVIDE WHERE INDICATED.
⊕DBT	DOOR BELL TRANSFORMER	PROVIDE WHERE INDICATED.
⊕MB	MULTIMEDIA BOX	PROVIDE WHERE INDICATED.
⊕	FAN COIL UNIT	FURNISHED & INSTALLED BY MECH (ELECTRICAL PROVIDE POWER TO THE UNIT PER NEC)
⊕	PHOTOCELL	EXTERIOR WEATHERPROOF PHOTOCELL CONTROL FOR DUSK TO DAWN OPERATION
⊕	WALL SWITCH, LOW VOLTAGE BATHROOM FAN SPEED CONTROL	FURNISHED & INSTALLED BY ELEC

NOTE: NOT ALL ITEMS USED ON PROJECT.

APARTMENT NOTES:

- ALL ELECTRICAL WORK SHALL COMPLY WITH ALL LOCAL AND NATIONAL CODES.
- DEVICE BOXES ON OPPOSITE SIDES OF DEMISING WALLS SHALL BE IN SEPARATE STUD BAYS. PROVIDE BACKING EQUIVALENT TO LOWRY'S OUTLET BOX PADS. CONDUIT FROM ONE UNIT SHALL NOT PASS THROUGH STUDS OF A SHARED WALL(DOUBLE STUDS) FROM AN ADJACENT UNIT(BRIDGING).
- PROVIDE ARC-FAULT PROTECTION, TAMPER PROOF AND GFCI RECEPTACLES AS REQUIRED BY CODE AND LOCAL AHJ. ARC-FAULT PROTECTION MUST BE PROVIDED FOR CIRCUITS IN THE AREAS LISTED IN NEC 210.12(A).
- PROVIDE SUFFICIENT DUPLEX RECEPTACLES TO MEET NEC 210.52.
- THERMOSTATS SHALL NOT INTERFERE WITH DOOR SWINGS.
- ELECTRICAL CONTRACTOR SHALL MAKE ALL FINAL CONNECTIONS FOR KITCHEN APPLIANCES. COORDINATE ALL J-BOX LOCATIONS WITH APPLIANCE INSTALLATION INSTRUCTIONS PRIOR TO ROUGH-IN.
- ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL CORD AND PLUG ASSEMBLY FOR EACH DISPOSER.
- PROVIDE A DEDICATED 20 AMP CIRCUIT TO EACH UNIT BATHROOM RECEPTACLE. BATHROOM LIGHTS, FAN TO BE ON SAME CIRCUIT PER 210.11(C)(3) EXCEPTION.
- HOME RUNS AND LOOPS CONNECTING LIGHT FIXTURES, WIRING DEVICES, AND HVAC EQUIPMENT ON PLANS INDICATE CIRCUITING SCHEME. SEE TYPICAL PANEL SCHEDULES FOR ACTUAL CIRCUIT NUMBERS FOR TYPICAL APARTMENT.
- LIGHTS WITHIN 3' HORIZONTAL OF SHOWER OR TUB TO BE WET LOCATION RATED AND HAVE FULLY ENCLOSED TRIMS. PROVIDE GFCI PROTECTION IF THE LUMINAIRE INSTALLATION MANUAL STATES IT IS REQUIRED.
- PROVIDE SMOKE DETECTORS AND CO ALARMS AS REQUIRED. DETECTORS AND ALARMS TO BE HARDWIRED AND PROVIDED WITH BATTERY BACKUP.
- ELECTRICAL CONTRACTOR SHALL INSTALL RECEPTACLES AND TV, DATA/PHONE OUTLETS UNDER COMMON COVER PLATE WHERE POSSIBLE. PROVIDE AND INSTALL DIVIDERS AS REQUIRED FOR CABLE/POWER SEPARATION.
- SEE ARCHITECTURAL DRAWINGS FOR DIMENSIONS AND LAYOUTS OF ALL DEVICES.
- ALL WALL PENETRATIONS SHALL BE CAULKED WITH APPROVED MATERIAL TO MAINTAIN THE FIRE RATING OF ALL WALLS AND FLOORS.
- ALL CONDUIT SHALL BE INSTALLED IN NEAT SYMMETRICAL LINES HORIZONTAL OR PERPENDICULAR TO BUILDING COLUMNS AND ROOF LINES. CONDUITS SHALL BE GROUPED ON COMMON SUPPORTS WHEREVER POSSIBLE.
- REFERENCE MECHANICAL DRAWINGS FOR EXACT LOCATION OF ALL MECHANICAL EQUIPMENT.
- ELECTRICAL CONTRACTOR SHALL VERIFY ALL FUSE RATING WIRE SIZES AND DISCONNECT SIZES WITH EQUIPMENT SERVED ON THE JOB PRIOR TO INSTALLATION.
- SEE ARCHITECTURAL DRAWINGS AND ELEVATIONS FOR ADDITIONAL DETAILS AND CASEWORK DIMENSIONS.
- DEVICE LOCATIONS IN 1ST DWELLING/RESIDENT UNIT SHALL BE REVIEWED AND APPROVED BY OWNER PRIOR TO ROUGH-IN OF REMAINING UNITS
- CONFIRM FINAL LOCATION OF HEATERS AND THERMOSTATS IN FIELD PRIOR TO ROUGH-IN

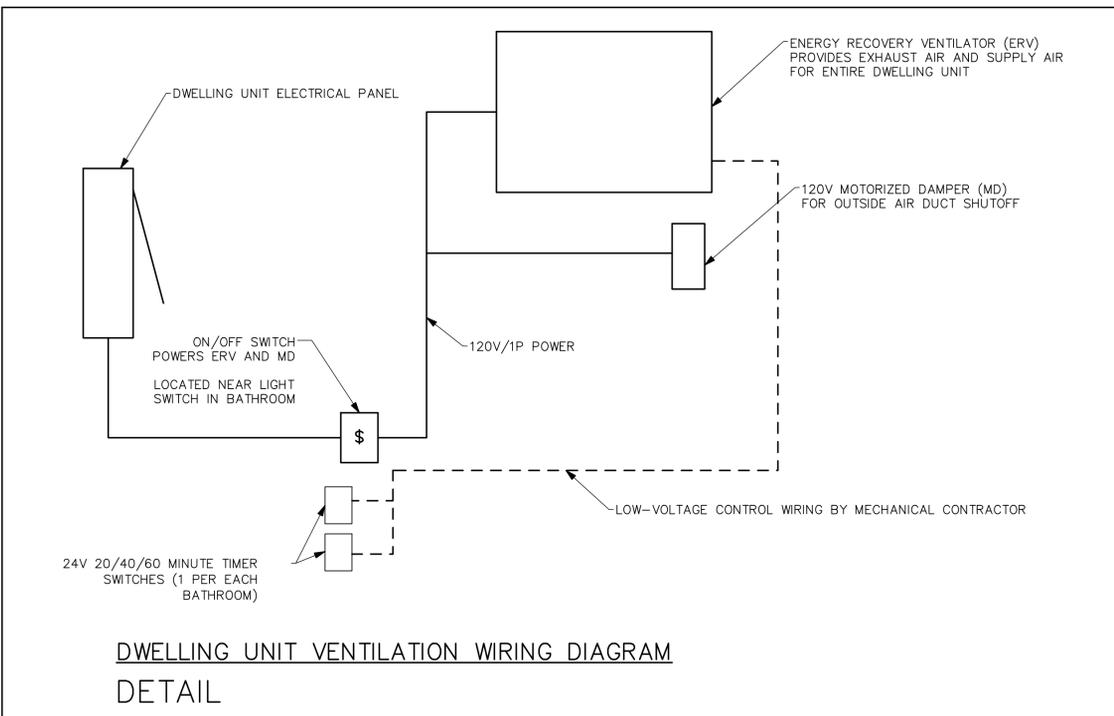

ELECTRIC HEATERS

EQUIP NO.	SERVICE	MOUNTING/DISCHARGE	HEATING KW	ELECTRICAL VOLTAGE	BASIS OF DESIGN
EWH-1	BEDROOM	WALL	1	208V/1P	KING WHF
EWH-0.75	BATHROOM	WALL	0.5	208V/1P	KING WHF

NOTES: (1) BROAN, CADET OR EQUIVALENT. (2) PROVIDE REMOTE THERMOSTAT.

ACCESSIBILITY NOTES:

- ALL SWITCHES AND CONTROLS - 15" MIN; 48" MAX TO CONTROL.
- GENERAL OUTLETS MIN 18" AFF.
- ALL SWITCHES/CONTROLS ABOVE COUNTERTOPS 48" MAX.
- ELECTRICAL SUB-PANELS IN UNITS MUST COMPLY WITH ABOVE REACH RANGES.
- SWITCHES FOR EXHAUST HOODS AND GARBAGE DISPOSALS MUST COMPLY WITH ABOVE REACH RANGES. INSTALL SWITCHES ON FACE OF CABINETS IF REQUIRED TO COMPLY.



REVISIONS	DESCRIPTION	DATE
NO.		



DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: **EAST TOWN CROSSING BUILDING A**
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA


19401 40TH AVE W, SUITE 302
LYNNWOOD, WA 98036
PHONE: 206-936-3343

ROBISON ENGINEERING, INC

PERMIT SET
07/29/2025

SHEET TITLE:
UNIT PLANS NOTES


SHEET NO.
E5.00

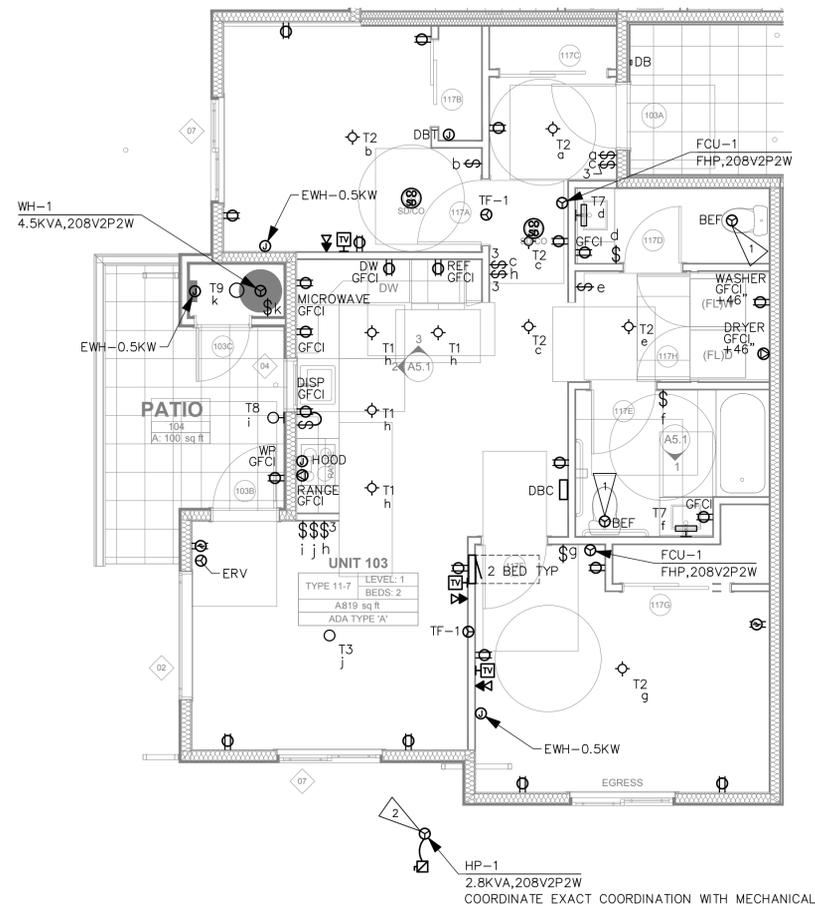

UNIT TYPICALS

ADA TYPE 'A'

SCALE: 1/4" = 1'-0"

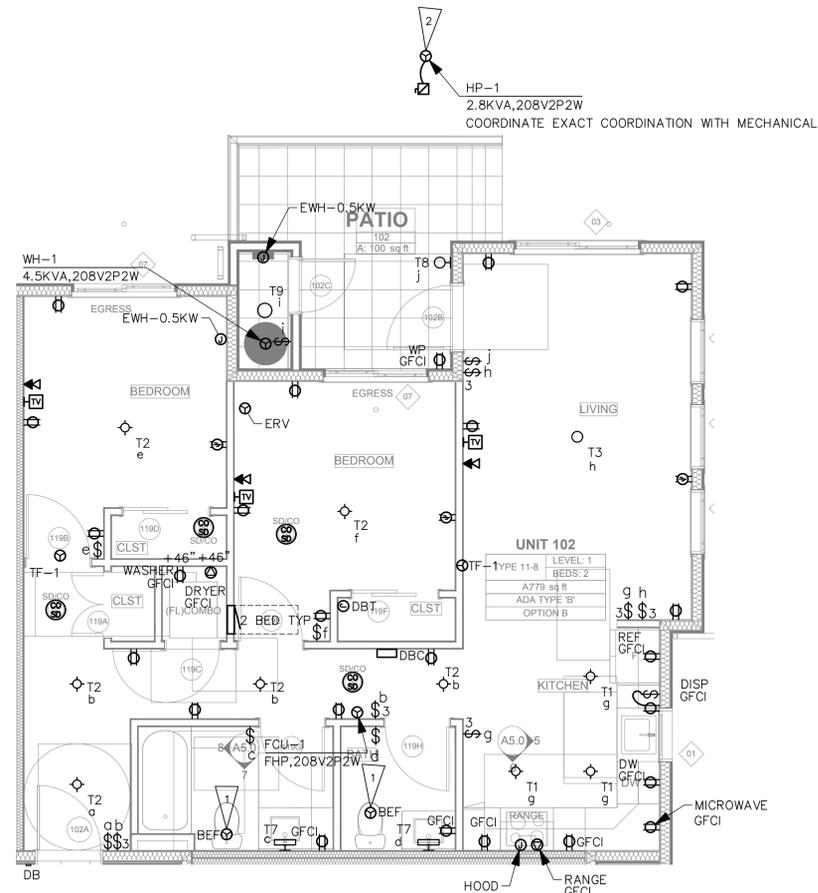

UNIT TYPICALS

ADA TYPE 'B'

SCALE: 1/4" = 1'-0"


GENERAL NOTES:

1. PROVIDE AFCI BREAKERS PER NEC 210.12.
2. PROVIDE TAMPER RESISTANT RECEPTACLES PER NEC 406.12.
3. PROVIDE ADA COMPLIANT CONTROLS FOR RANGE HOODS & CEILING FANS IN UNITS DESIGNATED AS 'ACCESSIBLE' PER ARCHITECTURAL.

FLAG NOTES

1. TWO-SPEED WHOLE HOUSE FAN CONTROLLED BY INTEGRAL OCCUPANCY SENSOR. HIGH SPEED OPERATION WHEN OCCUPIED, LOW SPEED OPERATION OTHERWISE. PROVIDE UNSWITCHED HOT.
2. COORDINATE OUTDOOR LOCATION OF INDIVIDUAL HP UNITS WITH MECHANICAL PLANS.

NO.	DATE	REVISIONS DESCRIPTION



DRAWN:	LYSAK K.
DESIGNED:	LYSAK K.
CHECKED:	STEINKE M.
APPROVED:	STEINKE M.

PROJECT: EAST TOWN CROSSING BUILDING A
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: 206-964-3343

ROBISON ENGINEERING, INC

PERMIT SET
 07/29/2025

SHEET TITLE:
UNIT PLANS

SHEET NO.
 E5.01

GENERAL FEEDER SCHEDULE

ID	FEEDER AMPS	CONDUIT AND FEEDER	FEEDING THESE DEVICES
1	125	1-1/2" C, 2#2/0 AL, #2/0 AL N, #4 AL G	105, 106, 107, 108, 206, 207, 208, 306, 307, 308
10	800	(3) 3" C, 3#400kcmil AL, #400kcmil AL N, #4/0 AL G	UTIL
17	200	2-1/2" C, 3#250kcmil AL, #250kcmil AL N, #4 AL G	HOUSE
19	800	(3) 3" C, 3#400kcmil AL, #400kcmil AL N	MC-A

SIZING METHOD: COPPER, 60°C #12 THROUGH #1, 75°C 1/0 AND ABOVE

FEEDER SCHEDULE NOTES:

- CONDUIT FILL:
- * FOR CONDUIT SIZES 1-1/2" AND BELOW, FILL IS BASED ON EMT.
- * FOR CONDUIT SIZES 2" AND ABOVE, FILL IS BASED ON SCHEDULE 40 PVC.

IN LOCATIONS APPROVED FOR THE PURPOSE, CONTRACTOR MAY USE MC CABLE. IN LOCATIONS APPROVED FOR THE PURPOSE CONTRACTOR MAY USE OTHER CONDUIT TYPES, INCLUDING RMC, FMC AND LFMC. CONTRACTOR REQUIRED TO ENSURE CONDUIT FILL DOES NOT EXCEED 40%.

CONTRACTOR RESPONSIBLE TO ENSURE TERMINATION/LUG CAPACITY FOR ALL SCHEDULED FEEDERS.

XHHW/THHN/THWN SHALL BE USED FOR INSULATION OF THE CONDUCTOR.

PHASE 1 EV BREAKDOWN: 241 PARKING SPACES * 0.1 = 25 EV CHARGERS					PHASE 2 EV BREAKDOWN: 120 PARKING SPACES * 0.1 = 12 EV CHARGERS						
Bldg	# EV Spaces	208V 1PH load (KVA)	208/120V 3PH load (A)	50% load management infrastructure (KVA)	50% load management infrastructure (A)	Bldg	# EV chargers	208V 1PH load (KVA)	208/120V 3PH load (A)	50% load management infrastructure (KVA)	50% load management infrastructure (A)
B	4	33.28	92.38	16.64	46.19	F	6	49.92	138.57	24.96	69.29
C	4	33.28	92.38	16.64	46.19	A	2	16.64	46.19	8.32	23.1
D	4	33.28	92.38	16.64	46.19	E	4	33.28	92.38	16.64	46.19
G	2	16.64	46.19	8.32	23.1	Club	2	16.64	46.19	8.32	23.1
Bus	8	66.56	184.76	33.28	92.38						
H	2	16.64	46.19	8.32	23.1						
Total	24	199.68	554.28	99.84	277.14	Total	14	116.48	323.33	58.24	161.67

REQUIRED ELECTRIC VEHICLE CHARGING INFRASTRUCTURE WAC 51-50-0429:

- WHERE PARKING IS PROVIDED, TEN PERCENT OF PARKING SPACES SHALL BE PROVIDED WITH ELECTRIC VEHICLE CHARGING INFRASTRUCTURE.
- ELECTRICAL ROOM(S) SERVING PARKING AREAS SHALL BE DESIGNED TO ACCOMMODATE THE ELECTRICAL EQUIPMENT AND DISTRIBUTION REQUIRED TO SERVE A MINIMUM OF 20 PERCENT OF THE TOTAL PARKING SPACES WITH 208/240 V 40-AMP ELECTRIC VEHICLE CHARGING INFRASTRUCTURE.
- MINIMUM ONE ACCESSIBLE PARKING SPACE SHALL BE SERVED BY ELECTRIC VEHICLE CHARGING INFRASTRUCTURE.



TOTAL NUMBER OF PARKING SPACES = 246; 246 x 0.2 = CAPACITY FOR 50 EV CHARGERS
 50 CHARGERS x 208V/1PH x 40A = 416 KVA = 1155 A 3 PHASE POWER @ 120/208V

UTILIZING LOAD MANAGEMENT INFRASTRUCTURE, EV LOAD CAN BE REDUCED BY 50%. 2,126.22A/2 = 208 KVA (578 A) @ 208V 3 PHASE.

PER WAC 427, ELECTRICAL INFRASTRUCTURE SHALL BE DESIGNED TO ACCOMMODATE AN 578 AMPS OF ELECTRICAL EV LOAD.

FAULT CURRENT SCHEDULE


DEVICE	FAULT	AIC RATING	L-N VOLTS	UTILITY FAULT	FED FROM		FEEDER		TOTAL MOTOR FAULT
					DEVICE	FAULT	SIZE	LENGTH	
UTIL	40,144	NA	120V	39,700					444
MC-A	25,453	42,000	120V	25,001	UTIL	39,700	(3)#400kcmil AL	94'	452
HOUSE	19,115	42,000	120V	18,779	MC-A	25,001	#250kcmil AL	20'	336
105	7,098	22,000	120V	7,042	MC-A	25,001	#2/0 AL	81'	56
106	7,266	22,000	120V	7,207	MC-A	25,001	#2/0 AL	78'	59
107	5,006	22,000	120V	4,965	MC-A	25,001	#2/0 AL	124'	41
108	6,130	22,000	120V	6,081	MC-A	25,001	#2/0 AL	97'	49
206	5,115	22,000	120V	5,073	MC-A	25,001	#2/0 AL	121'	42
207	4,391	22,000	120V	4,354	MC-A	25,001	#2/0 AL	145'	37
208	4,522	22,000	120V	4,483	MC-A	25,001	#2/0 AL	140'	39
306	4,815	22,000	120V	4,775	MC-A	25,001	#2/0 AL	130'	40
307	4,168	22,000	120V	4,132	MC-A	25,001	#2/0 AL	154'	36
308	4,286	22,000	120V	4,249	MC-A	25,001	#2/0 AL	149'	37

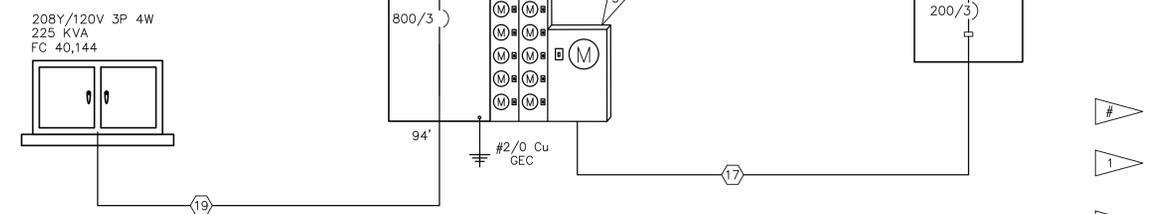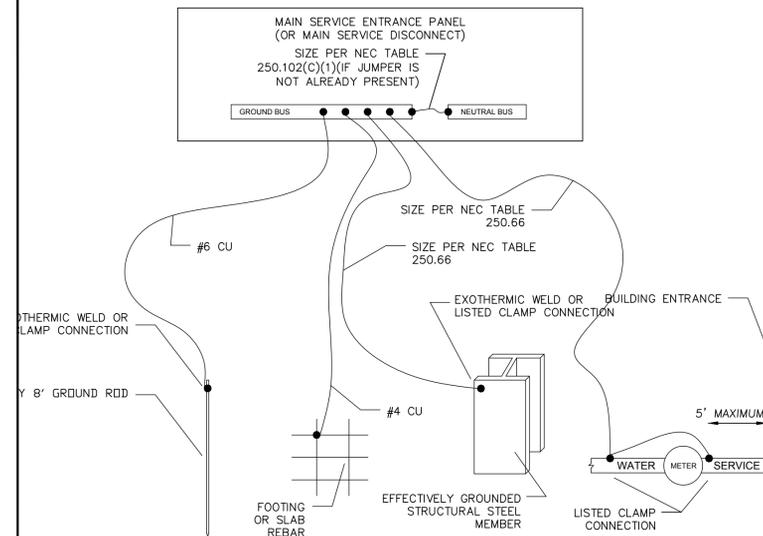

FLAG NOTES

- UNIT FEEDERS: REFER TO METER CENTER PANEL SCHEDULE ON THIS SHEET FOR UNIT FEEDER SIZE & TYPE. TYP.
- CONTRACTOR SHALL VERIFY AVAILABLE FAULT CURRENT WITH PSE SERVICE LETTER PRIOR TO ORDERING EQUIPMENT.
- HOUSE PANEL METER AND MAIN BREAKER.
- PROVISIONAL BREAKER SPACE AND CONDUIT FOR FUTURE PV SYSTEM. LOCATE BREAKER SPACE AT
- BUSBAR SIZED PER NEC 705.12(B)(2).
- PROVIDE (2) 2 1/2" CONDUITS FOR SOLAR READY PATHWAY AND RESERVE SPACE IN THE MAIN ELECTRIC ROOM FOR FUTURE SOLAR EQUIPMENT. RESERVE SPACE FOR INSTALLATION OF FUTURE SOLAR CIRCUIT BREAKER AND PERMANENTLY MARK THIS LOCATION AS "FOR FUTURE SOLAR ELECTRIC".

REVISIONS	DESCRIPTION	DATE	NO.



DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: EAST TOWN CROSSING BUILDING A
 MULTIFAMILY DEVELOPMENT
 PIONEER WAY & SHAW RD. PUYALLUP, WA

ROBISON ENGINEERING, INC
 19401 40TH AVE W. SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 964-3343

PERMIT SET
 07/29/2025

SHEET TITLE:
ONE-LINE DIAGRAM & PANELS SCHEDULES

SHEET NO.
 E6.00


MC-A		ROOM MOUNTING FLUSH FED FROM UTIL		VOLTS 208Y/120V 3P 4W BUS AMPS 800 NEUTRAL 100%		AIC 42,000 MAIN BKR 800 LUGS STANDARD	
CKT #	BREAKER TRIP/POLES	CIRCUIT DESCRIPTION	LOAD KVA			FEEDER RACEWAY AND CONDUCTORS	
			A	B	C		
1	125/2	PANEL 101	18.2	18.2	18.2	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G	
2	125/2	PANEL 102	18.2	18.2	18.2	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G	
3	125/2	PANEL 103	18.2	18.2	18.2	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G	
4	125/2	PANEL 104	18.2	18.2	18.2	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G	
5	125/2	PANEL 202	18.2	18.2	18.2	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G	
6	125/2	PANEL 203	18.2	18.2	18.2	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G	
7	125/2	PANEL 204	18.2	18.2	18.2	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G	
8	125/2	PANEL 201	18.2	18.2	18.2	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G	
9	125/2	PANEL 304	18.2	18.2	18.2	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G	
10	125/2	PANEL 301	18.2	18.2	18.2	1-1/2"C,2#2/0 AL,#2/0 AL N,#4 AL G	
11	200/3	PANEL HOUSE	10.3	14.7	9.93	2-1/2"C,3#250kcmil AL,#250kcmil AL N,#4 AL G	
12	-/2	SPACE	0		0		
TOTAL CONNECTED KVA BY PHASE			138	142	119		
OPTIONAL MULTIFAMILY DWELLING CALCULATION (NEC 220.84)							
DWELLING UNIT LOADS							
KVA				KVA			
LIGHTING AND RECEPTACLES	24.6	8,200 SF (3 VA/SF)	CONNECTED LOAD	328			
SMALL-APPLIANCE	30		DWELLING UNITS DEMAND FACTOR	10 (43%)			
LAUNDRY APPLIANCES	15		CALCULATED LOAD	141			
ELECTRIC COOKING	81						
MOTORS	12						
HEATING	16.3	(100%)					
COOLING	1.3	(0%)					
HOUSE LOADS							
CONN KVA		CALC KVA		CONN KVA		CALC KVA	
LIGHTING	0.407	0.509	(125%)	RECEPTACLES	1.98	1.98	(50%>10)
LARGEST MOTOR	11.6	2.91	(25%)	EV LOAD	13.2	13.2	(100%)
MOTORS	17.3	17.3	(100%)	NONCONTINUOUS	0.1	0.1	(100%)
				HEATING	2	2	(100%)
TOTAL HOUSE LOAD				38			
TOTAL LOAD							
KVA		KVA		KVA		KVA	
TOTAL DWELLING UNIT LOAD	141	TOTAL LOAD	179	TOTAL HOUSE LOAD	38	BALANCED 3-PHASE LOAD	497 A

HOUSE		ROOM MOUNTING FLUSH FED FROM MC-A		VOLTS 208Y/120V 3P 4W BUS AMPS 200 NEUTRAL 100%		AIC 42,000 MAIN BKR 200 LUGS STANDARD	
CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION	CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION
1	20/1	0.72	RECEPTACLE	a 2	20/2	0.1	COURTYARD LIGHTING
3	20/1	0.36	RECEPTACLE	b 4			
5	20/1	0.18	RECEPTACLE	c 6	20/1	0.1	SITE LIGHTING
7	20/1	0.36	RECEPTACLE	a 8	20/1	0.207	LIGHTING
9	20/1	0.18	FACP	b 10	-/1	0	SPACE
11	40/2	6.6	DUAL EV CHARGER	c 12	20/3	5.65	BP-1
13				a 14			
15	-/1	0	SPACE	b 16			
17	-/1	0	SPACE	c 18	20/2	1	1KW HEATER
19	40/2	6.6	DUAL EV CHARGER	a 20			
21				b 22	80/3	11.6	TRASH COMPACTOR
23	-/1	0	SPACE	c 24			
25	-/1	0	SPACE	a 26			
27	-/1	0	SPACE	b 28	20/1	0.1	TRASH CONTROLLER
29	-/1	0	SPACE	c 30	20/2	1	1KW HEATER
31	-/1	0	SPACE	a 32			
33	-/1	0	SPACE	b 34	20/1	0.18	RECEPTACLE
35	-/1	0	SPACE	c 36	-/1	0	SPACE
37	-/1	0	SPACE	a 38	-/3	0	FUTURE SOLAR
39	-/2	0	SPACE	b 40			
41				c 42			
CONN KVA				CONN KVA			
LIGHTING	0.407	0.509	(125%)	RECEPTACLES	1.98	1.98	(50%>10)
LARGEST MOTOR	11.6	2.91	(25%)	EV LOAD	13.2	13.2	(100%)
MOTORS	17.3	17.3	(100%)	NONCONTINUOUS	0.1	0.1	(100%)
				HEATING	2	2	(100%)
TOTAL LOAD				38			
BALANCED 3-PHASE LOAD				105 A			
PHASE A		124%		PHASE B		85.6%	
PHASE B		85.6%		PHASE C		90%	

1 BED		ROOM MOUNTING FLUSH FED FROM		VOLTS 208/120V 2P 3W BUS AMPS 125 NEUTRAL 100%		AIC 22,000 MAIN BKR MLO LUGS STANDARD	
CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION	CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION
1	15/1	1	LVG RM R/L, SD/CO	a 2	20/1	1.5	SML APPLIANCE/REF
3	15/1	1	BED RM R/L	b 4	20/1	1.5	SML APPLIANCE/DINING
5	15/1	1	BED RM R/L	a 6	20/1	0.8	DISHWASHER
7	20/1	1	BATHROOM REC/LTG	b 8	20/1	1.2	DISPOSAL
9	20/2	1	WALL HEATER BEDS	a 10	40/2	8.1	RANGE
11				b 12			
13	20/2	2.8	HEAT PUMP, FCU-1	a 14	20/1	1.8	MICRO/HOOD
15				b 16	30/2	5	DRYER
17	30/2	4.5	HPWH-1	a 18			
19				b 20	20/1	1.5	WASHER
21	-/1	0	SPACE	a 22	15/1	0.13	ERV
23	-/1	0	SPACE	b 24	-/1	0	SPACE
25	-/1	0	SPACE	a 26	-/1	0	SPACE
27	-/1	0	SPACE	b 28	-/1	0	SPACE
29	-/1	0	SPACE	a 30	-/1	0	SPACE
CONN KVA				CONN KVA			
LIGHTING AND RECEPTACLES	2.4	800 SF (3 VA/SF)	GENERAL LOAD	UP TO 10 KVA			
SMALL-APPLIANCE	3		LAUNDRY APPLIANCES	OVER 10 KVA			
LAUNDRY APPLIANCES	1.5		ELECTRIC COOKING	MAX HEATING OR COOLING			
ELECTRIC COOKING	8.1		MOTORS	1.2			
MOTORS	1.2		TOTAL GENERAL LOAD	31.1			
TOTAL LOAD				19.2			
BALANCED LOAD				92.4 A			
PHASE A		100%		PHASE B		99.9%	

2 BED		ROOM MOUNTING FLUSH FED FROM		VOLTS 208/120V 2P 3W BUS AMPS 125 NEUTRAL 100%		AIC 22,000 MAIN BKR MLO LUGS STANDARD	
CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION	CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION
1	15/1	1	LVG RM R/L, SD/CO	a 2	20/1	1.5	SML APPLIANCE/REF
3	15/1	1	OFFICE R/L	b 4	20/1	1.5	SML APPLIANCE/DINING
5	15/1	1	BED RM R/L	a 6	20/1	0.8	DISHWASHER
7	15/1	1	BED RM R/L	b 8	20/1	1.2	DISPOSAL
9	20/1	1	BATHROOM REC/LTG	a 10	40/2	8.1	RANGE
11	20/1	1	BATHROOM REC/LTG	b 12			
13	20/2	1.5	WALL HEATER BEDS	a 14	20/1	1.8	MICRO/HOOD
15				b 16	30/2	5	DRYER
17	20/2	2.8	HEAT PUMP, FCU-1	a 18			
19				b 20	20/1	1.5	WASHER
21	30/2	4.5	HPWH-1	a 22	15/1	0.13	ERV
23				b 24	-/1	0	SPACE
25	-/1	0	SPACE	a 26	-/1	0	SPACE
27	-/1	0	SPACE	b 28	-/1	0	SPACE
29	-/1	0	SPACE	a 30	-/1	0	SPACE
CONN KVA				CONN KVA			
LIGHTING AND RECEPTACLES	2.46	820 SF (3 VA/SF)	GENERAL LOAD	UP TO 10 KVA			
SMALL-APPLIANCE	3		LAUNDRY APPLIANCES	OVER 10 KVA			
LAUNDRY APPLIANCES	1.5		ELECTRIC COOKING	MAX HEATING OR COOLING			
ELECTRIC COOKING	8.1		MOTORS	1.2			
MOTORS	1.2		TOTAL GENERAL LOAD	31.2			
TOTAL LOAD				19.6			
BALANCED LOAD				94.1 A			
PHASE A		100%		PHASE B		99.9%	

NO.	DATE	DESCRIPTION



DRAWN: LYSAK K.	DESIGNED: LYSAK K.	CHECKED: STEINKE M.	APPROVED: STEINKE M.
-----------------	--------------------	---------------------	----------------------

PROJECT: EAST TOWN CROSSING BUILDING A
MULTIFAMILY DEVELOPMENT
PIONEER WAY & SHAW RD. PUYALLUP, WA

19401 40TH AVE W, SUITE 302
 LYNNWOOD, WA 98036
 PHONE: (206) 964-3343

ROBISON ENGINEERING, INC

PERMIT SET
 07/29/2025

SHEET TITLE:
PANELS SCHEDULES

SHEET NO.
 E6.01