

Seismic Brace Report



Project Name Centeris Battery Replacement
Date 10/17/2025
Address 1023 39th Ave Se
Puyallup, WA 98374

APPROVAL STAMP

- ☐ Approved
☐ Approved as Noted
☐ Not Approved

Remarks:

Standard NFPA 13-2019

BRACE SUMMARY

Brace Name	Drawing Reference	Seismic Design Load	Structure	Brace Description	Fastener	Attachments
6" Lateral Brace		630 lbf.	Horizontal Beam Flange	Lateral Orientation 45° - 90° 1 NPS Sch 40		AF720 AF700 - 1/2" AF035 - 6 NPS x 1 NPS
6" Long Brace		1,102 lbf.	Horizontal Beam Flange	Longitudinal Orientation 45° - 90° 1 NPS Sch 40		AF720 AF700 - 1/2" AF730 - 6 NPS

NOTE: Per NFPA 13-2019, all load capacities listed for fasteners installed in cracked concrete have been reduced based on the prying factors listed for ASC's swivel attachments. Prying factors for NFPA fastener orientations "A" through "I" may be found in ASC's individual product submittal at asc-es.com

NFPA 13-2016 Product loads incorporate a minimum safety factor of 1.5. NFPA 13-2019 FM Product loads have been reduced to include a safety factor of 2.2 unless noted in the applicable product submittal.

The products specified within this report are limited to the capability of the sway brace assembly alone to resist the calculated seismic force resulting from user input . Point loads applied to structural elements as a result of seismic forces are not evaluated by the software. The seismic load rating of the fastener attached to a structural element is determined by one of the following: NFPA 13, UL listing, FM Global approval, or other empirical testing. The review of the of the structural element(s) as a whole and/or the entire structure and its ability to resist the seismic load(s) is beyond the scope of these seismic calculations.

ASC MAKES NO WARRANTIES , EXPRESS, IMPLIED, STATUTORY, OR OTHERWISE, WITH RESPECT TO THE SOFTWARE OR THE SEISMIC CALCULATIONS, AND ASC SPECIFICALLY DISCLAIMS ANY IMPLIED WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE.

6" LATERAL BRACE - SEISMIC BRACE CALCULATIONS

Seismic Project Centeris Battery Room Replacement
Standard NFPA 13-2019
Brace Type Lateral

Brace Name 6" Lateral Brace
Drawing Reference
Approval Agency UL Listed

STRUCTURE INFORMATION

Structure I-Beam/Joist
Substrate Horizontal Beam Flange
Thickness 0.19 in.-0.75 in.
Load Orientation Perpendicular to Beam

BRACE INFORMATION

Brace Member 1 NPS Sch 40
Brace Length Max 7 ft 0 in
Brace Angle 45° - 90°
Least Radius of Gyration 0.421 in.
I/r Ratio Max 200
Max Horizontal Load 1,310 lbf.

FASTENER INFORMATION


Fastener Name N/A

SEISMIC BRACE ATTACHMENTS

	Model	Size	Adj. Load
Structural Att.	AF720	N/A	1,131 lbf.
Swivel Att.	AF700	1/2"	1,333 lbf.
Pipe Att.	AF035	6 NPS x 1 NPS	1,333 lbf.

See Appendix A for alternate seismic brace attachments.

All seismic brace attachments manufactured by ASC Engineered Solutions.

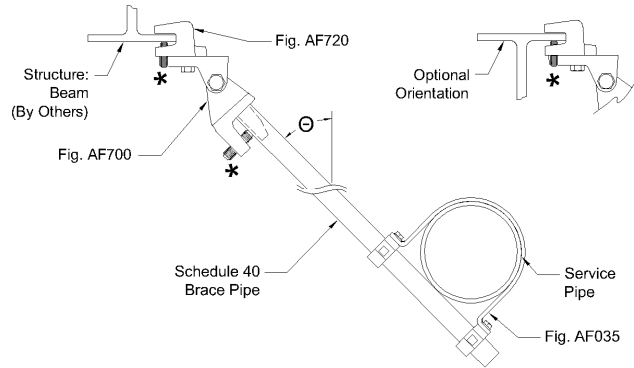

* - denotes hardware shown with the bolt head or nut broken off, as per the product installation instructions

Net Vertical Reaction Forces do not need to be addressed per NFPA 13-2019.

SPRINKLER SYSTEM LOAD CALCULATION ($F_{PW} = C_p * W_p$) $C_p = 0.594$

Qty	Line	Description	Pipe Size/Type	Length	Weight/ft	Weight/Line	Total Weight
1	Main	Braced Pipe	6 NPS Steel Sch 10	40.00 ft.	23.03 lb/ft.	921.20 lb.	921.20 lb.

Weakest Main Size 6 NPS Steel Sch 10
Spacing 40 ft.
Max Fpw 1,900 lbf.

Total System Weight 921.20 lb.
System Design Weight (W_p) 1,060.00 lb.
Horizontal Seismic Load (F_{pw}) 630 lbf.

6" LONG BRACE - SEISMIC BRACE CALCULATIONS

Seismic Project Centeris Battery Room Replacement
Standard NFPA 13-2019
Brace Type Longitudinal

Brace Name 6" Long Brace
Drawing Reference
Approval Agency UL Listed

STRUCTURE INFORMATION

Structure I-Beam/Joist
Substrate Horizontal Beam Flange
Thickness 0.19 in.-0.75 in.
Load Orientation Perpendicular to Beam

BRACE INFORMATION

Brace Member 1 NPS Sch 40
Brace Length Max 7 ft 0 in
Brace Angle 45° - 90°
Least Radius of Gyration 0.421 in.
I/r Ratio Max 200
Max Horizontal Load 1,310 lbf.

FASTENER INFORMATION


Fastener Name N/A

SEISMIC BRACE ATTACHMENTS

	Model	Size	Adj. Load
Structural Att.	AF720	N/A	1,131 lbf.
Swivel Att.	AF700	1/2"	1,333 lbf.
Pipe Att.	AF730	6 NPS	1,333 lbf.

See Appendix A for alternate seismic brace attachments.

All seismic brace attachments manufactured by ASC Engineered Solutions.

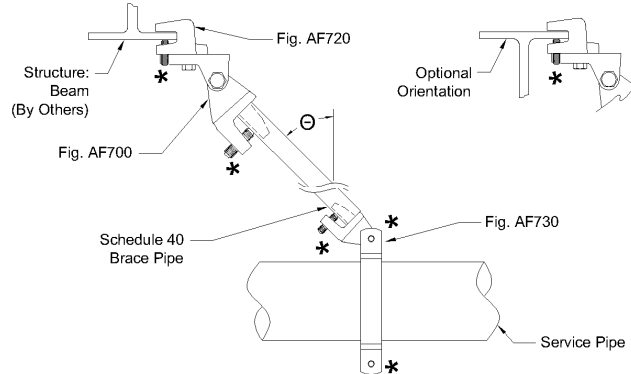

* - denotes hardware shown with the bolt head or nut broken off, as per the product installation instructions

Net Vertical Reaction Forces do not need to be addressed per NFPA 13-2019.

SPRINKLER SYSTEM LOAD CALCULATION ($F_{PW} = C_p * W_p$) $C_p = 0.594$

Qty	Line	Description	Pipe Size/Type	Length	Weight/ft	Weight/Line	Total Weight
1	Main	Braced Pipe	6 NPS Steel Sch 10	70.00 ft.	23.03 lb/ft.	1,612.10 lb.	1,612.10 lb.

Total System Weight	1,612.10 lb.
System Design Weight (W_p)	1,854.00 lb.
Horizontal Seismic Load (F_{pw})	1,102 lbf.

Appendix A - Alternate Seismic Brace Attachments

6" LATERAL BRACE


Structural Attachment	Structural Attach. Size	Structural Attach. Capacity	Swivel	Pipe Attachment
AF778	--	1,131 lbf.	AF771 1 NPS x 1/2" 1,414 lbf.	AF735 6 NPS x 1 NPS 1,333 lbf.
AF778	--	1,131 lbf.	AF700 1/2" 1,333 lbf.	AF775 6 NPS x 1 NPS 770 lbf.
AF778	--	1,131 lbf.	AF076 1/2" 1,237 lbf.	AF730 6 NPS 1,333 lbf.
AF720	--	1,131 lbf.	AF771 1 NPS x 1/2" 1,414 lbf.	--
AF727	--	1,333 lbf.	AF727 1/2" 1,333 lbf.	--
AF720	--	1,131 lbf.	AF076 1/2" 1,237 lbf.	--
AF087	--	968 lbf.	AF075 1 NPS x 1/2" 968 lbf.	--
AF087	--	968 lbf.	AF076 1/2" 1,237 lbf.	--
AF086	--	968 lbf.	AF075 1 NPS x 1/2" 968 lbf.	--
AF086	--	968 lbf.	AF076 1/2" 1,237 lbf.	--
AF086	--	968 lbf.	AF700 1/2" 1,333 lbf.	--
AF086	--	968 lbf.	AF771 1 NPS x 1/2" 1,414 lbf.	--

6" LONG BRACE


Structural Attachment	Structural Attach. Size	Structural Attach. Capacity	Swivel	Pipe Attachment
AF778	--	1,131 lbf.	AF771 1 NPS x 1/2" 1,414 lbf.	--
AF778	--	1,131 lbf.	AF700 1/2" 1,333 lbf.	--
AF778	--	1,131 lbf.	AF076 1/2" 1,237 lbf.	--
AF720	--	1,131 lbf.	AF771 1 NPS x 1/2" 1,414 lbf.	--
AF727	--	1,333 lbf.	AF727 1/2" 1,333 lbf.	--
AF720	--	1,131 lbf.	AF076 1/2" 1,237 lbf.	--

Appendix B - Enlarged Images

6" LATERAL BRACE

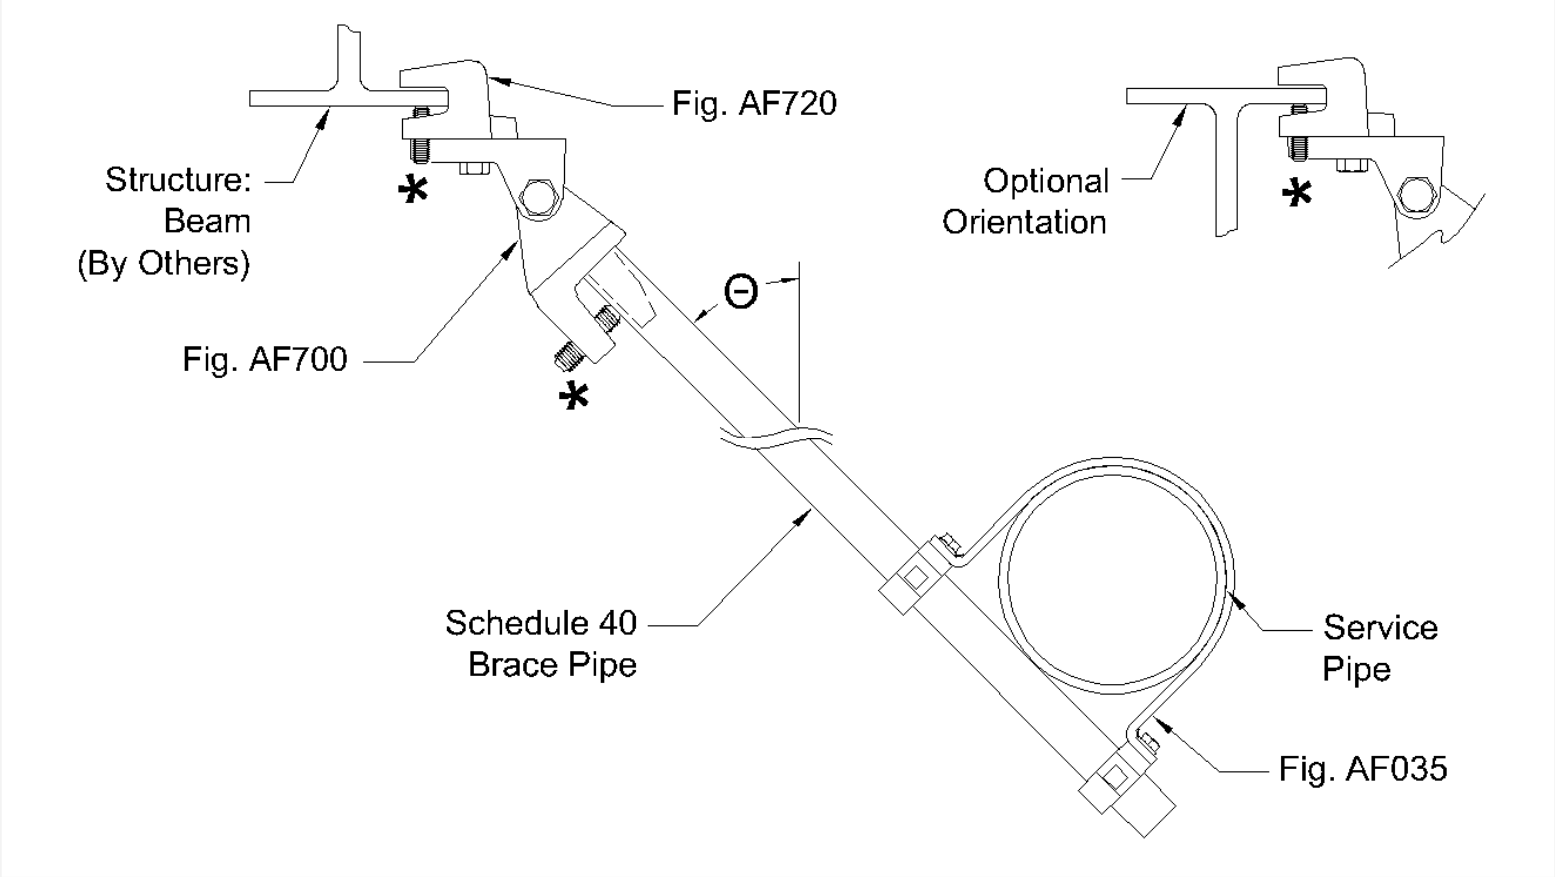

6" LONG BRACE

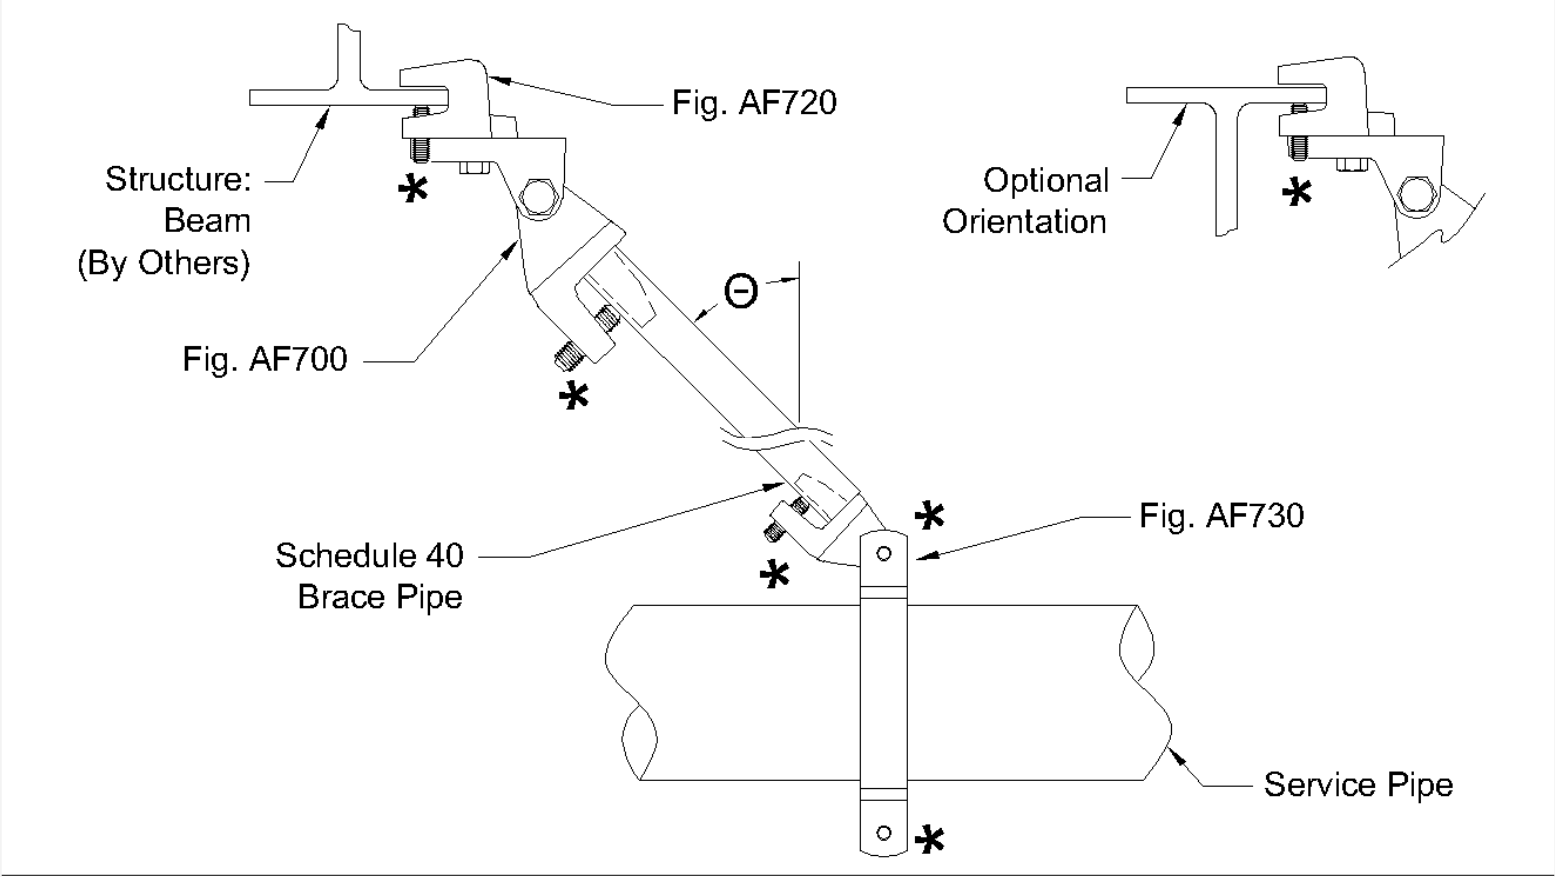

** - denotes hardware shown with the bolt head or nut broken off, as per the product installation instructions*

Appendix C - C_p Calculations

BRACE CALCULATION DATA

Brace Name	Brace Ref	Method	C _p	S _s	Site	F _a	S _{DS}	Z	H
6" Lateral Brace		A	0.594	1.257	--	--	--	--	--
6" Long Brace		A	0.594	1.257	--	--	--	--	--

CALCULATION METHODS

- A** C_p calculated per NFPA 13-2019 Table 18.5.9.3
- B** C_p entered by user
- C** C_p calculated per ASCE/SEI 7-16 per NFPA 13-2019 Section 18.5.9.4

LEGEND

F_{pw}	Seismic Horizontal Design Force
C_p	Seismic Coefficient per NFPA
S_s	Short Period MCEr Spectral Response Acceleration
F_a	Site Coefficient. See Tables Below.
S_{DS}	Short Period Spectral Acceleration
a_p	Component Amplification Factor. Taken as 2.5 for Fire Sprinkler Applications
R_p	Component Response Modification Factor. Taken as 4.5 for Fire Sprinkler Applications
I_p	Component Importance Factor. Taken as 1.5 for Fire Sprinkler Applications
W_p	Component Operating Weight. Taken as the weight of the Fire Sprinkler System in the ZOI plus 15%
z	Height in the structure where the component attaches to the structure. Height is relative to the base of the structure and shall not be taken as less than 0 and shall not be larger than "H".
H	Average roof height of the structure relative to the base

EQUATIONS...

$$F_{pw} = C_p W_p$$

$$\text{Where: } C_p = 0.7 * \frac{0.4 a_p S_{DS} I_p}{R_p} \left(1 + 2 \frac{Z}{H} \right)$$

$$\text{Where: } S_{DS} = \frac{2}{3} F_a S_s$$

$$C_{p \max} = 0.7 * 1.6 S_{DS} I_p$$

$$C_{p \min} = 0.7 * 0.3 S_{DS} I_p$$

SITE COEFFICIENT, F_A PER ASCE/SEI 7-16

	$S_s \leq 0.25$	$S_s = 0.5$	$S_s = 0.75$	$S_s = 1$	$S_s = 1.25$	$S_s \geq 1.5$
A	0.8	0.8	0.8	0.8	0.8	0.8
B	0.9	0.9	0.9	0.9	0.9	0.9
C	1.3	1.3	1.2	1.2	1.2	1.2
D	1.6	1.4	1.2	1.1	1	1
E	2.4	1.7	1.3	1.2	1.2	1.2

Use straight-line interpolation for intermediate values of S_s .


SITE CLASSIFICATION PER ASCE/SEI 7-16

Site Class

A
B
C
D
E

Ground Structure

Hard Rock
Rock
Very Dense Soil and Soft Rock
Stiff Soil
Soft Clay Soil

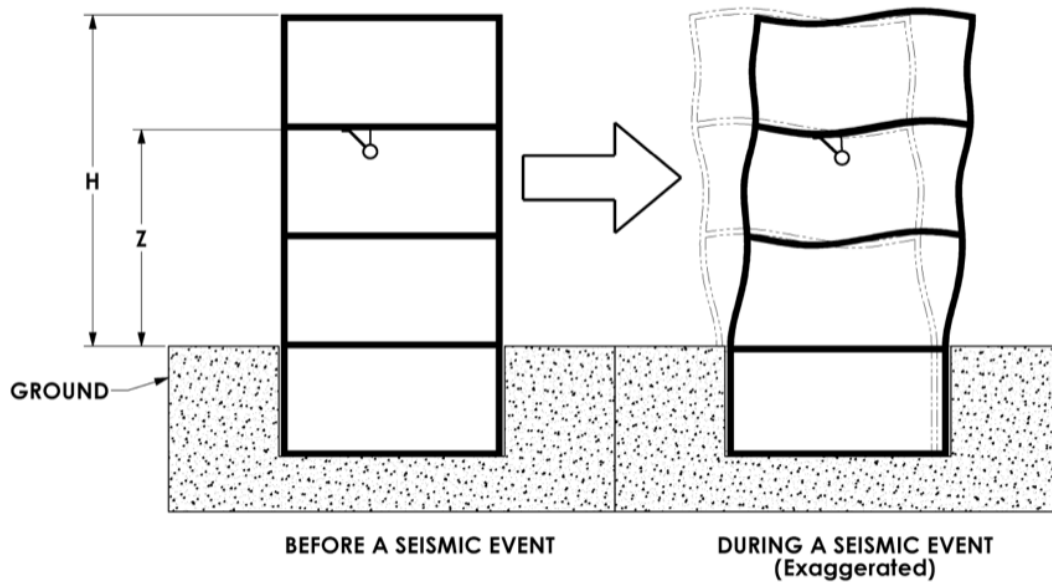

Appendix D - Bill of Materials

Project Name Centeris Battery Replacement
Code Requirements NFPA 13-2019
Last Updated October 17, 2025

QUANTITY	FIGURE NUMBER	PRODUCT	DESCRIPTION
0			Fastener
0	AF720	AF720 Universal Structural Seismic Brace Attachment	AF720
0	AF700	1/2" AF700 Universal Swivel Attachment	AF700 - 1/2"
	AF035	6 NPS AF035 Model K Brace Clamp	AF035 - 6 NPS x 1 NPS
	AF730	6 NPS AF730 Longitudinal & Lateral Seismic Clamp	AF730 - 6 NPS