



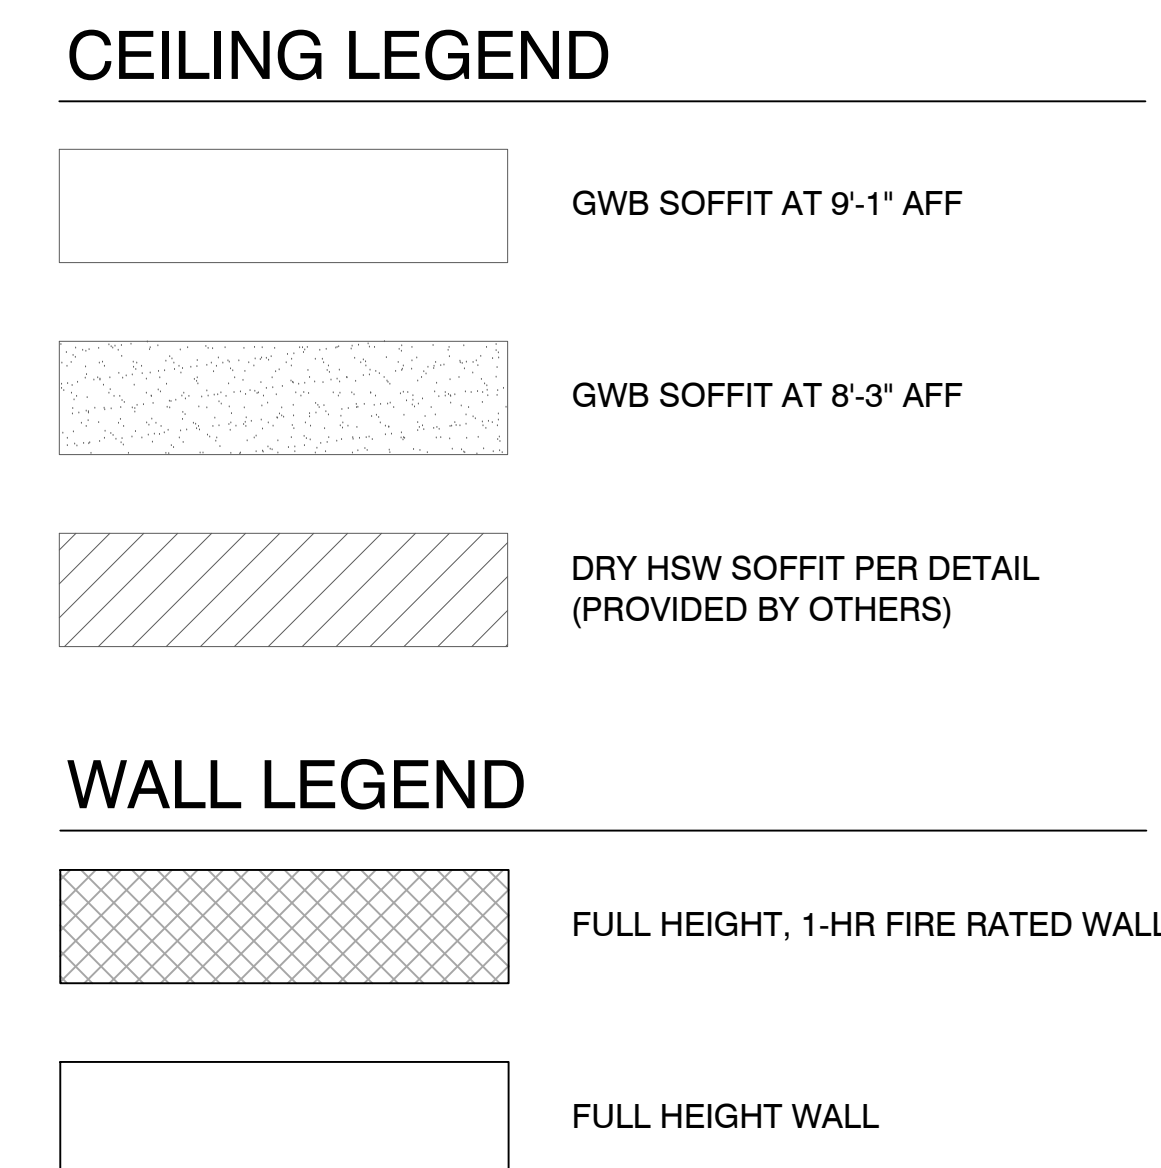


- # CPVC NOTES
1. CPVC PIPE IS NOTED AS: SIZE PER PLAN
 2. ALL CPVC ELEVATION TO BE 6 BOD, U.N.O.
 3. ALL CPVC TO BE BRACED PER DETAIL ON SHEET 4
 4. ALL CPVC BRANCHLINES AND DROPS TO BE 1", U.N.O.
 5. ALL CPVC MAINS TO BE 1.5", U.N.O.
 6. HANGER SPACING FOR CPVC PIPING IS PER MANUFACTURERS LISTING AS FOLLOWS:
 - 1" CPVC 8'-0" O.C.
 - 1-1/4" CPVC 6'-0" O.C.
 - 1-1/2" CPVC 7'-0" O.C.
 - 2" CPVC 8'-0" O.C.
 7. RELIABLE F1RES49 RESIDENTIAL SPRINKLERS SHALL NOT BE SPACED MORE THAN 8 FEET FROM A WALL IN ANY ONE DIRECTION OR 16 FEET BETWEEN SPRINKLERS IN COMPARTMENTS WITH (3) OR MORE HEADS.
 8. RELIABLE F1RES49 RESIDENTIAL SPRINKLERS SHALL NOT BE SPACED MORE THAN 9 FEET FROM A WALL IN ANY ONE DIRECTION OR 18 FEET BETWEEN SPRINKLERS IN COMPARTMENTS WITH (2) HEADS.
 9. RELIABLE F1RES49 RESIDENTIAL SPRINKLERS SHALL NOT BE SPACED MORE THAN 10 FEET FROM A WALL IN ANY ONE DIRECTION OR 20 FEET BETWEEN SPRINKLERS IN COMPARTMENTS WITH (1) OR LESS HEADS.
 10. RELIABLE F1RES49 RESIDENTIAL SPRINKLERS SHALL NOT BE SPACED LESS THAN 18" FROM PROTRUDING LIGHT FIXTURES.


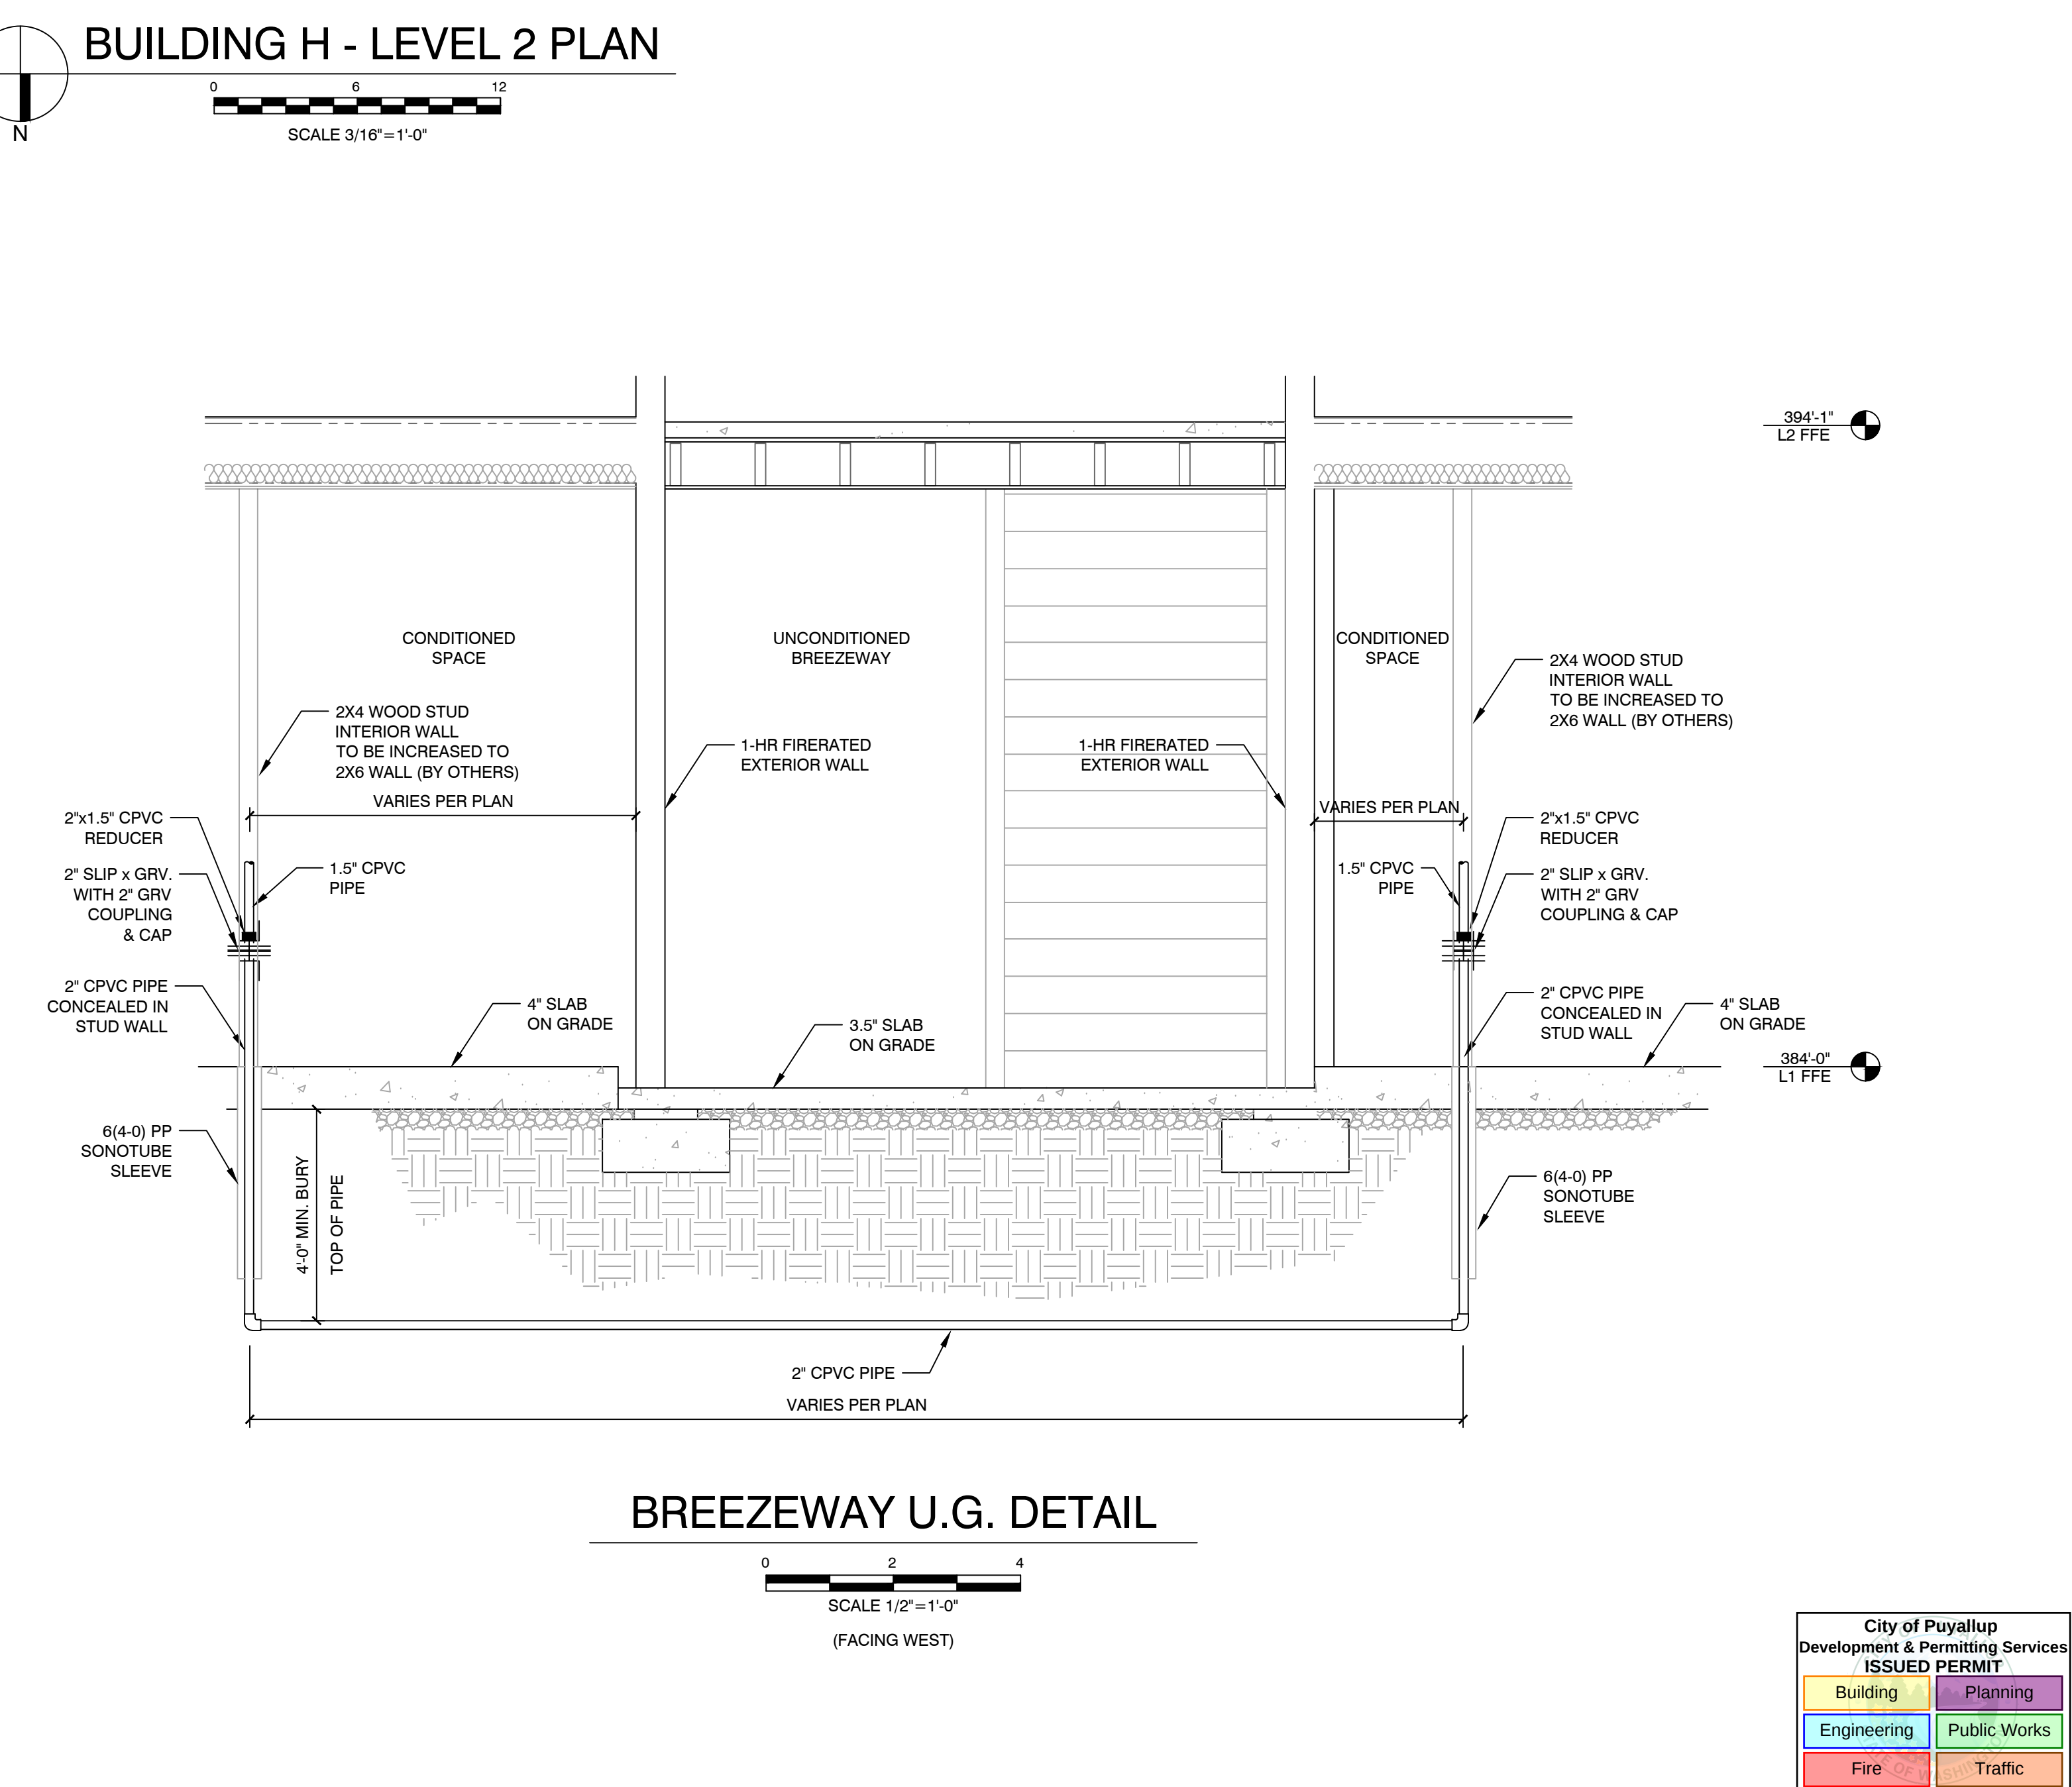


L1-L2 FLOOR PLAN

[illegible]

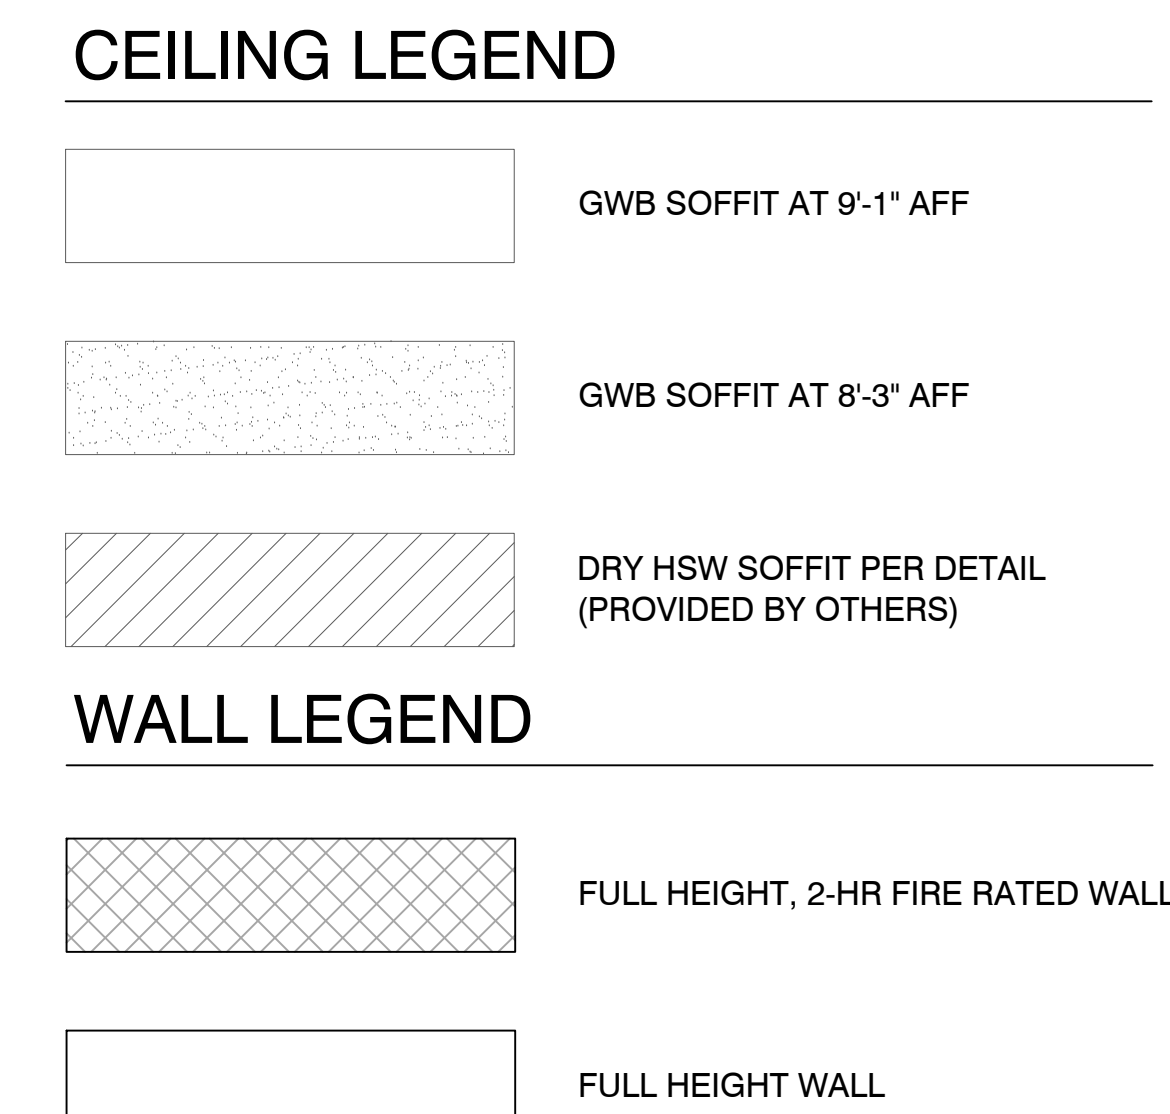

- # CPVC NOTES
1. CPVC PIPE IS NOTED AS: SIZE PER PLAN
 2. ALL CPVC ELEVATION TO BE 6 BOD. U.N.O.
 3. ALL CPVC TO BE BRACED PER DETAIL ON SHEET 4
 4. ALL CPVC BRANCHLINES AND DROPS TO BE 1", U.N.O.
 5. ALL CPVC MAINS TO BE 1.5", U.N.O.
 6. HANGER SPACING FOR CPVC PIPING IS PER MANUFACTURER'S LISTING AS FOLLOWS:
 - 1" CPVC 6'-0" O.C.
 - 1-1/4" CPVC 6'-0" O.C.
 - 1-1/2" CPVC 7'-0" O.C.
 - 2" CPVC 8'-0" O.C.
 7. RELIABLE F1RES49 RESIDENTIAL SPRINKLERS SHALL NOT BE SPACED MORE THAN 6 FEET FROM A WALL IN ANY ONE DIRECTION OR 16 FEET BETWEEN SPRINKLERS IN COMPARTMENTS WITH (3) OR MORE HEADS.
 8. RELIABLE F1RES49 RESIDENTIAL SPRINKLERS SHALL NOT BE SPACED MORE THAN 9 FEET FROM A WALL IN ANY ONE DIRECTION OR 18 FEET BETWEEN SPRINKLERS IN COMPARTMENTS WITH (2) HEADS.
 9. RELIABLE F1RES49 RESIDENTIAL SPRINKLERS SHALL NOT BE SPACED MORE THAN 10 FEET FROM A WALL IN ANY ONE DIRECTION OR 20 FEET BETWEEN SPRINKLERS IN COMPARTMENTS WITH (1) OR LESS HEADS.
 10. RELIABLE F1RES49 RESIDENTIAL SPRINKLERS SHALL NOT BE SPACED LESS THAN 18" FROM PROTRUDING LIGHT FIXTURES.

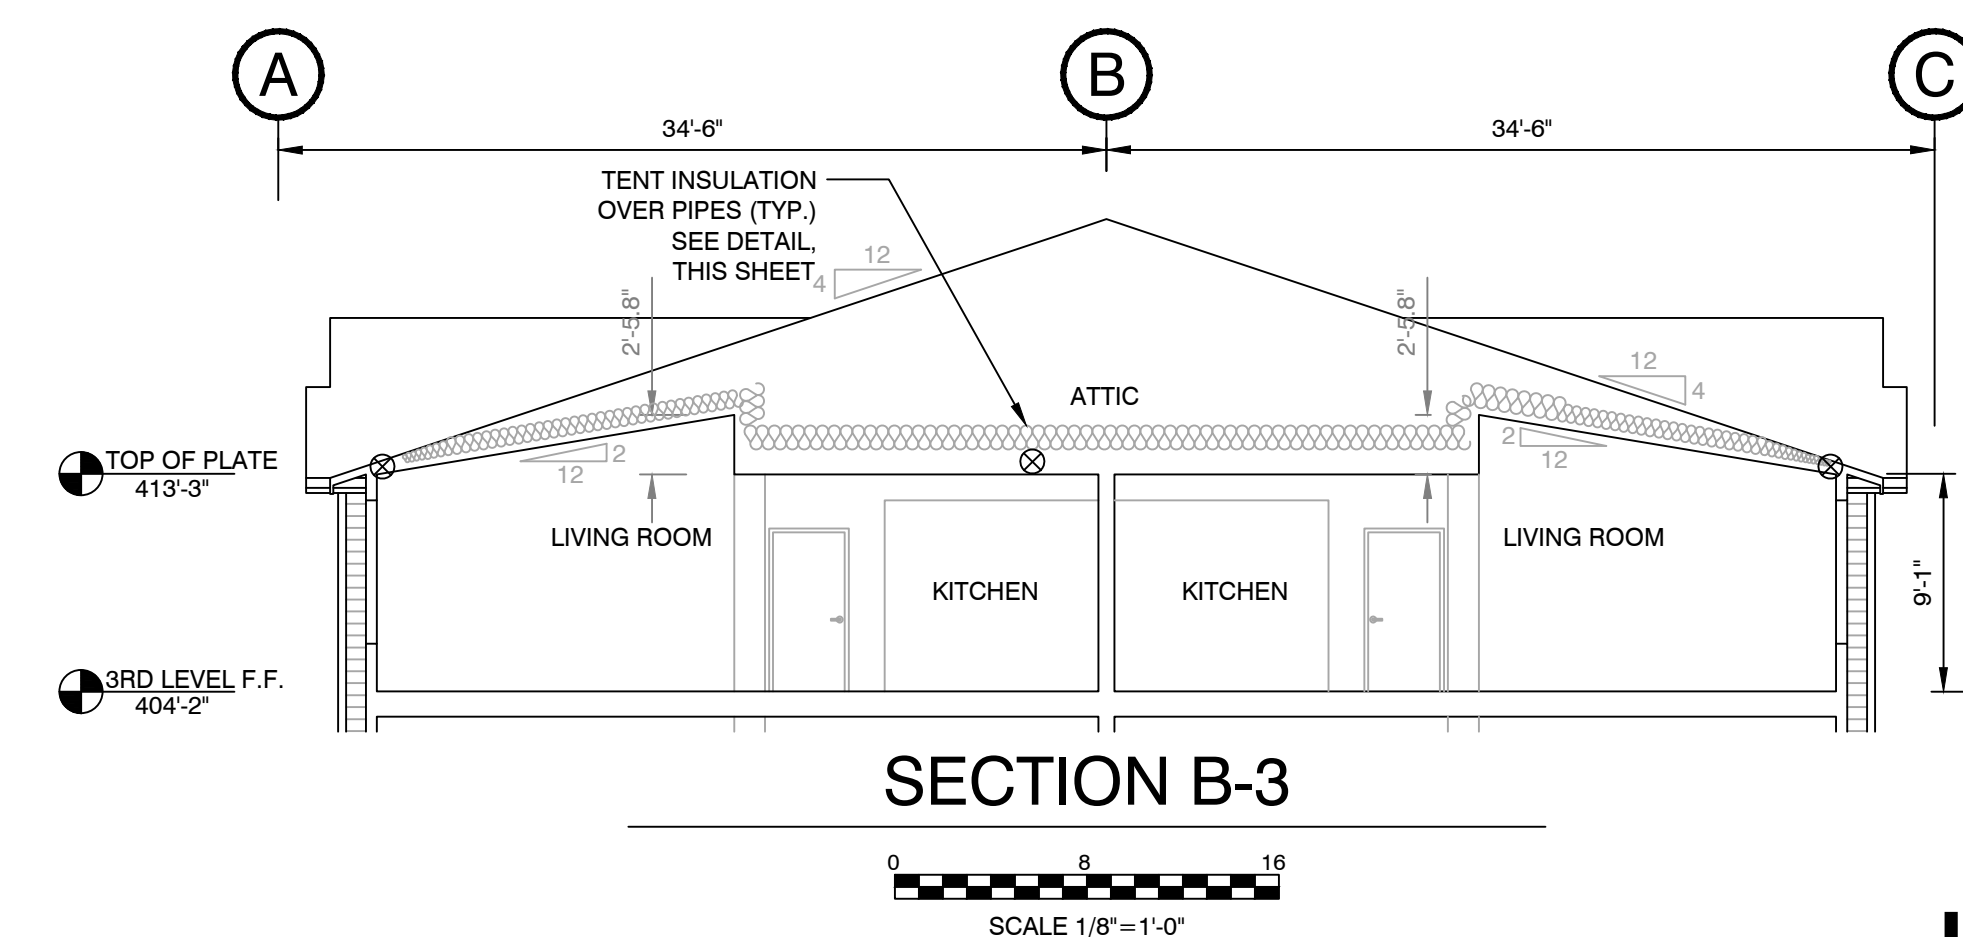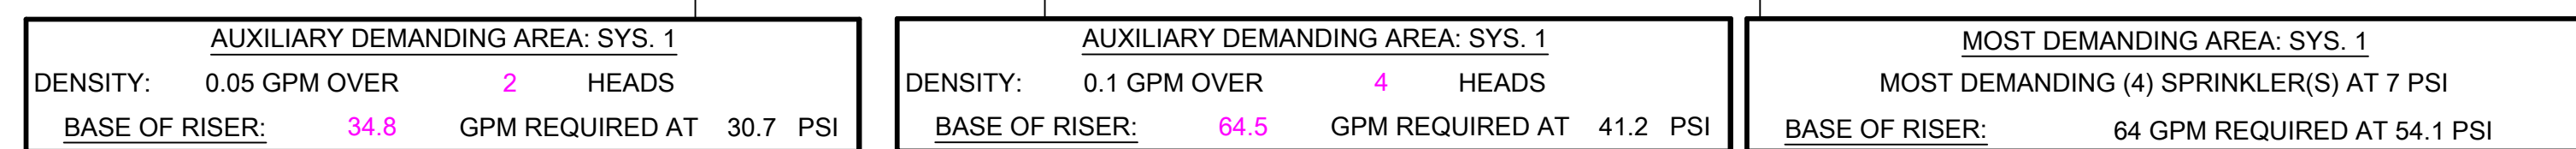

KEY PLAN

L3 FLOOR PLAN & DETAILS

DESIGNER	PROJECT MGR	DATE	SHEET	JOB NO.
A. RIDEOUT	N. GRASSI	11/06/25	3 OF 3	TC25207