
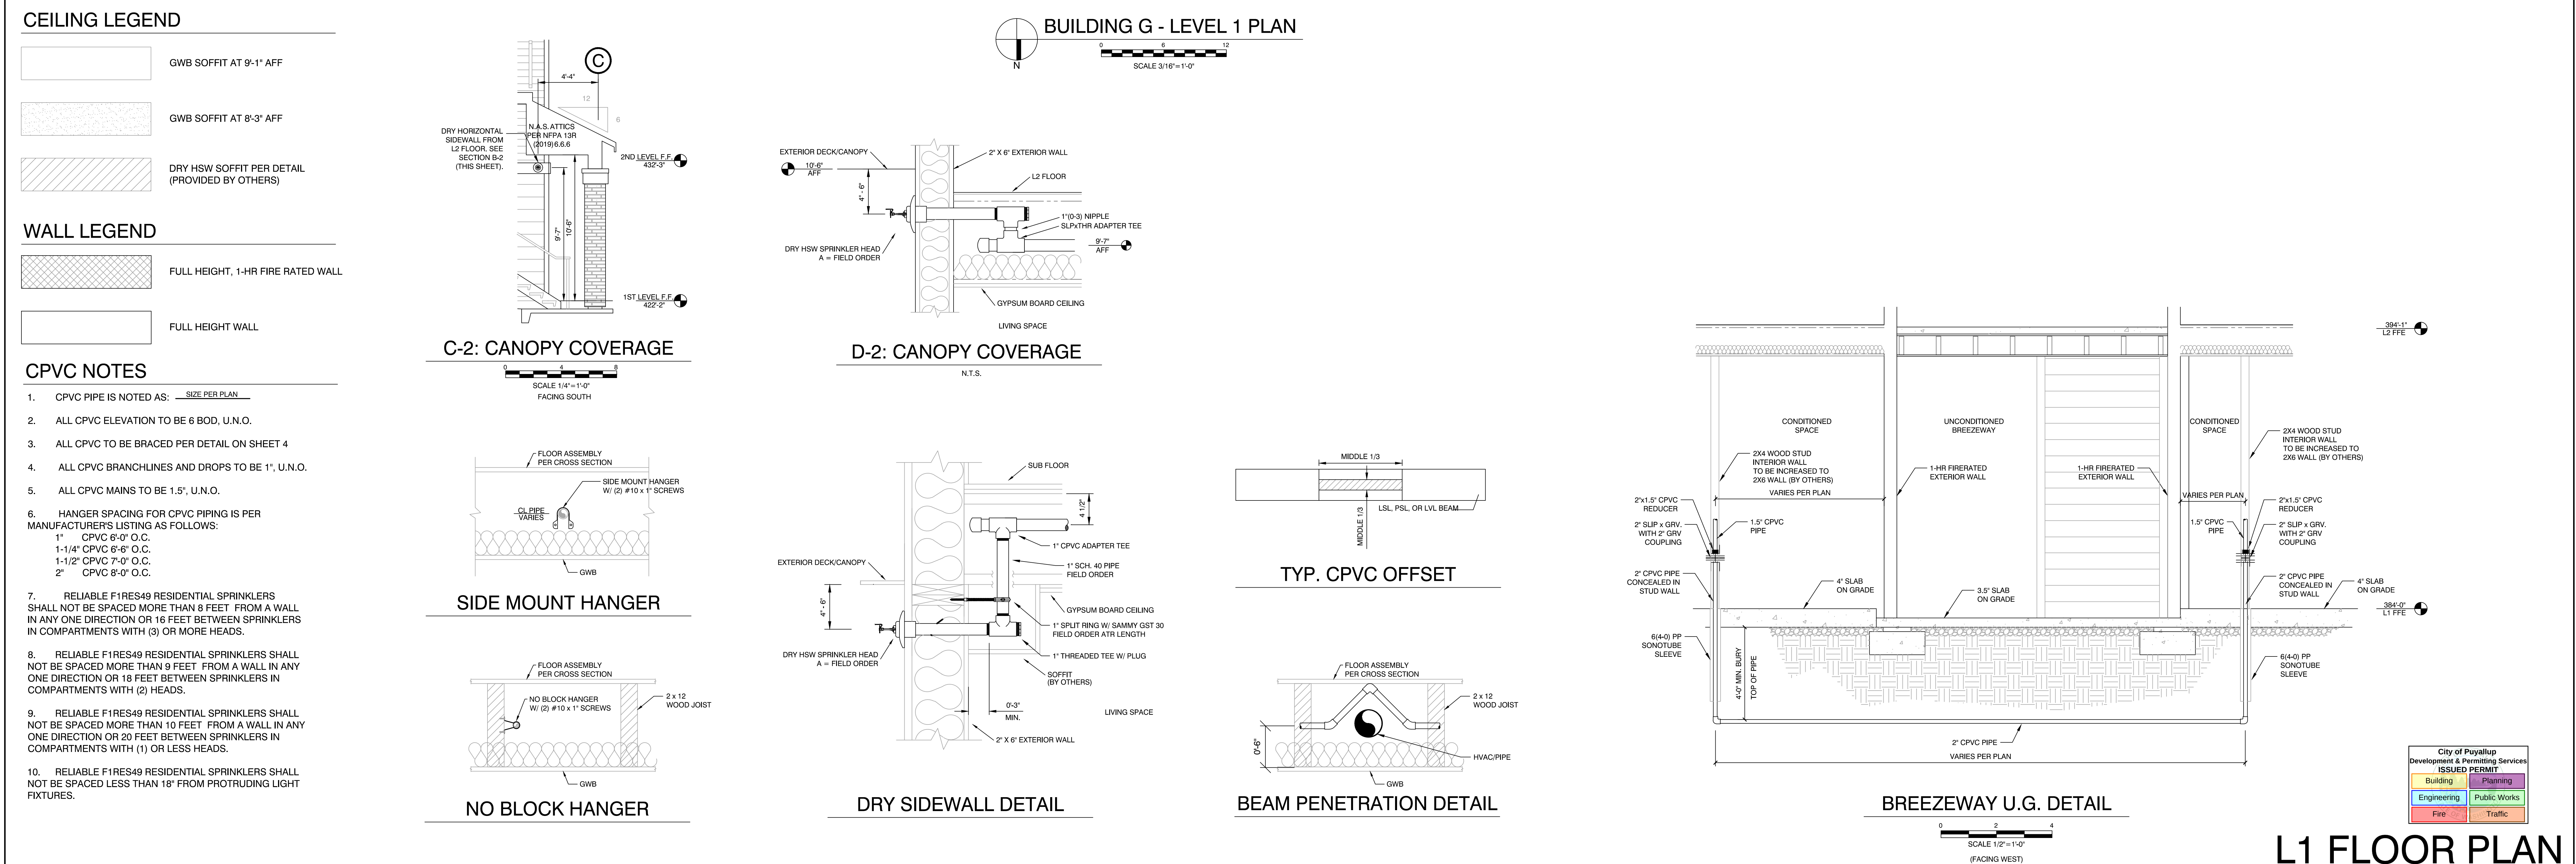
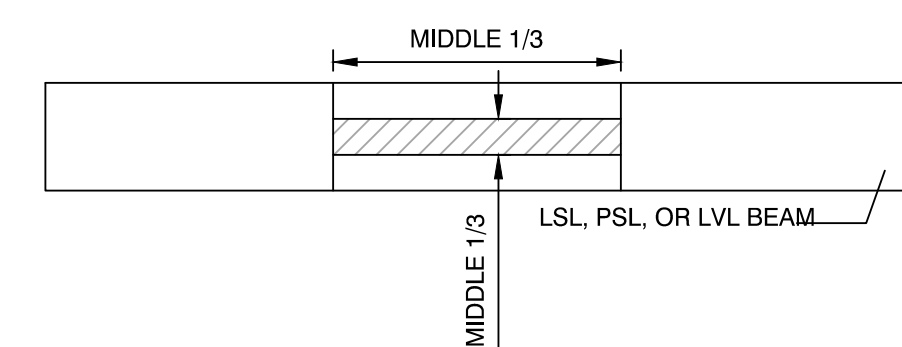


BRADLEY HEIGHTS APARTMENTS BUILDING G

206 27TH AVE SE
PUYALLUP, WA 98374

[illegible]

DESIGNER	PROJECT MGR	DATE	SHEET	JOB NO.
A. RIDEOUT	N. GRASSI	12/04/25	3 OF 4	TC25207


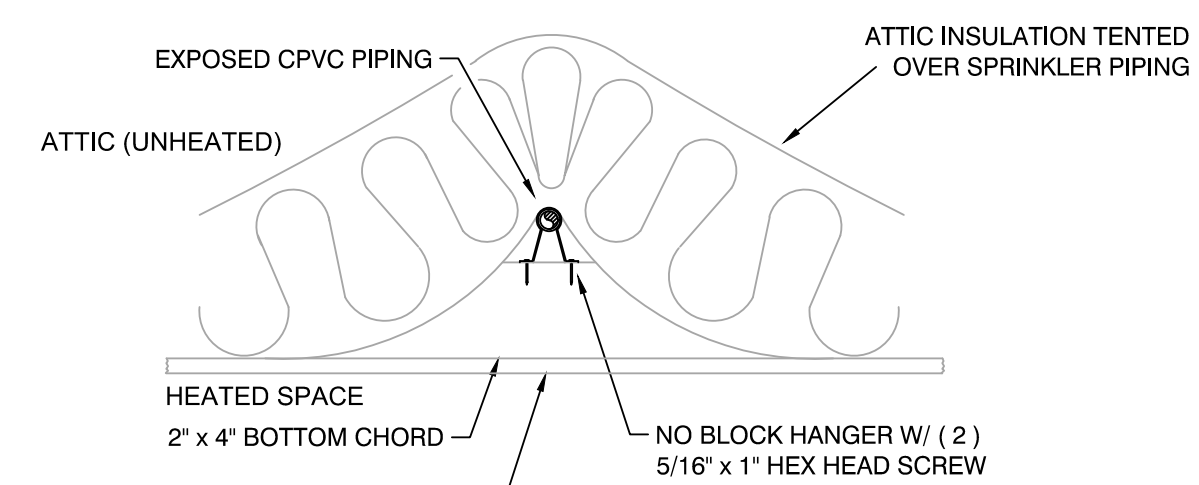


1. CPVC PIPE IS NOTED AS: SIZE PER PLAN
2. ALL CPVC ELEVATION TO BE 6 BDD, U.N.O.
3. ALL CPVC TO BE BRACED PER DETAIL ON SHEET 4
4. ALL CPVC BRANCHLINES AND DROPS TO BE 1", U.N.O.
5. ALL CPVC MAINS TO BE 1.5", U.N.O.
6. HANGER SPACING FOR CPVC PIPING IS PER
MANUFACTURERS LISTING AS FOLLOWS:
1" CPVC 6'-0" O.C.
1-1/4" CPVC 6'-6" O.C.
1-1/2" CPVC 7'-0" O.C.
2" CPVC 8'-0" O.C.

	GWB SOFFIT AT 9'-1" AFF
	GWB SOFFIT AT 8'-3" AFF
	DRY HSW SOFFIT PER DETAIL (PROVIDED BY OTHERS)

 FULL HEIGHT, 2-HR FIRE RATED WALL

 FULL HEIGHT WALL

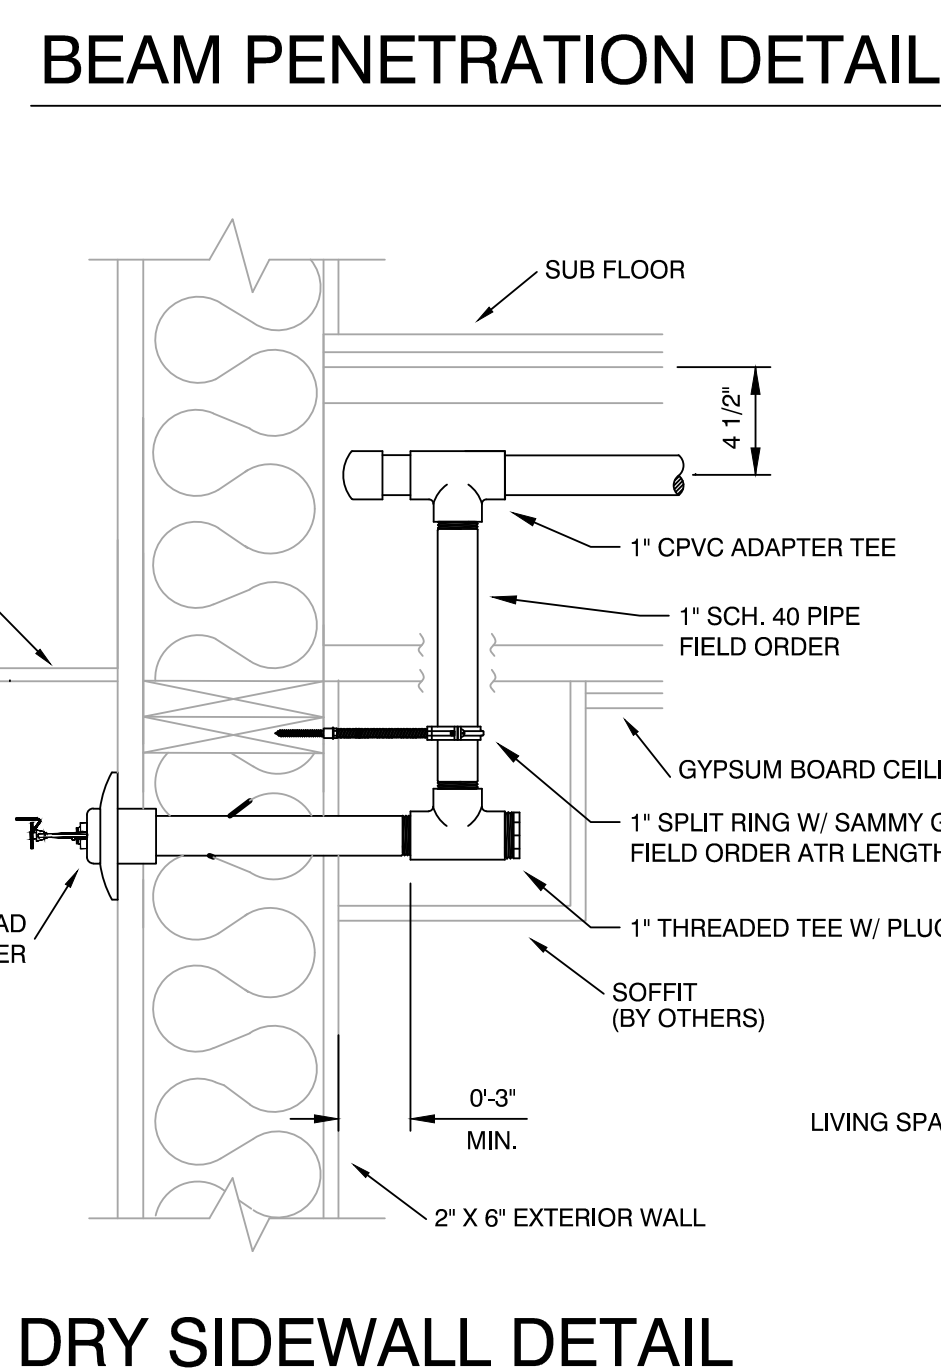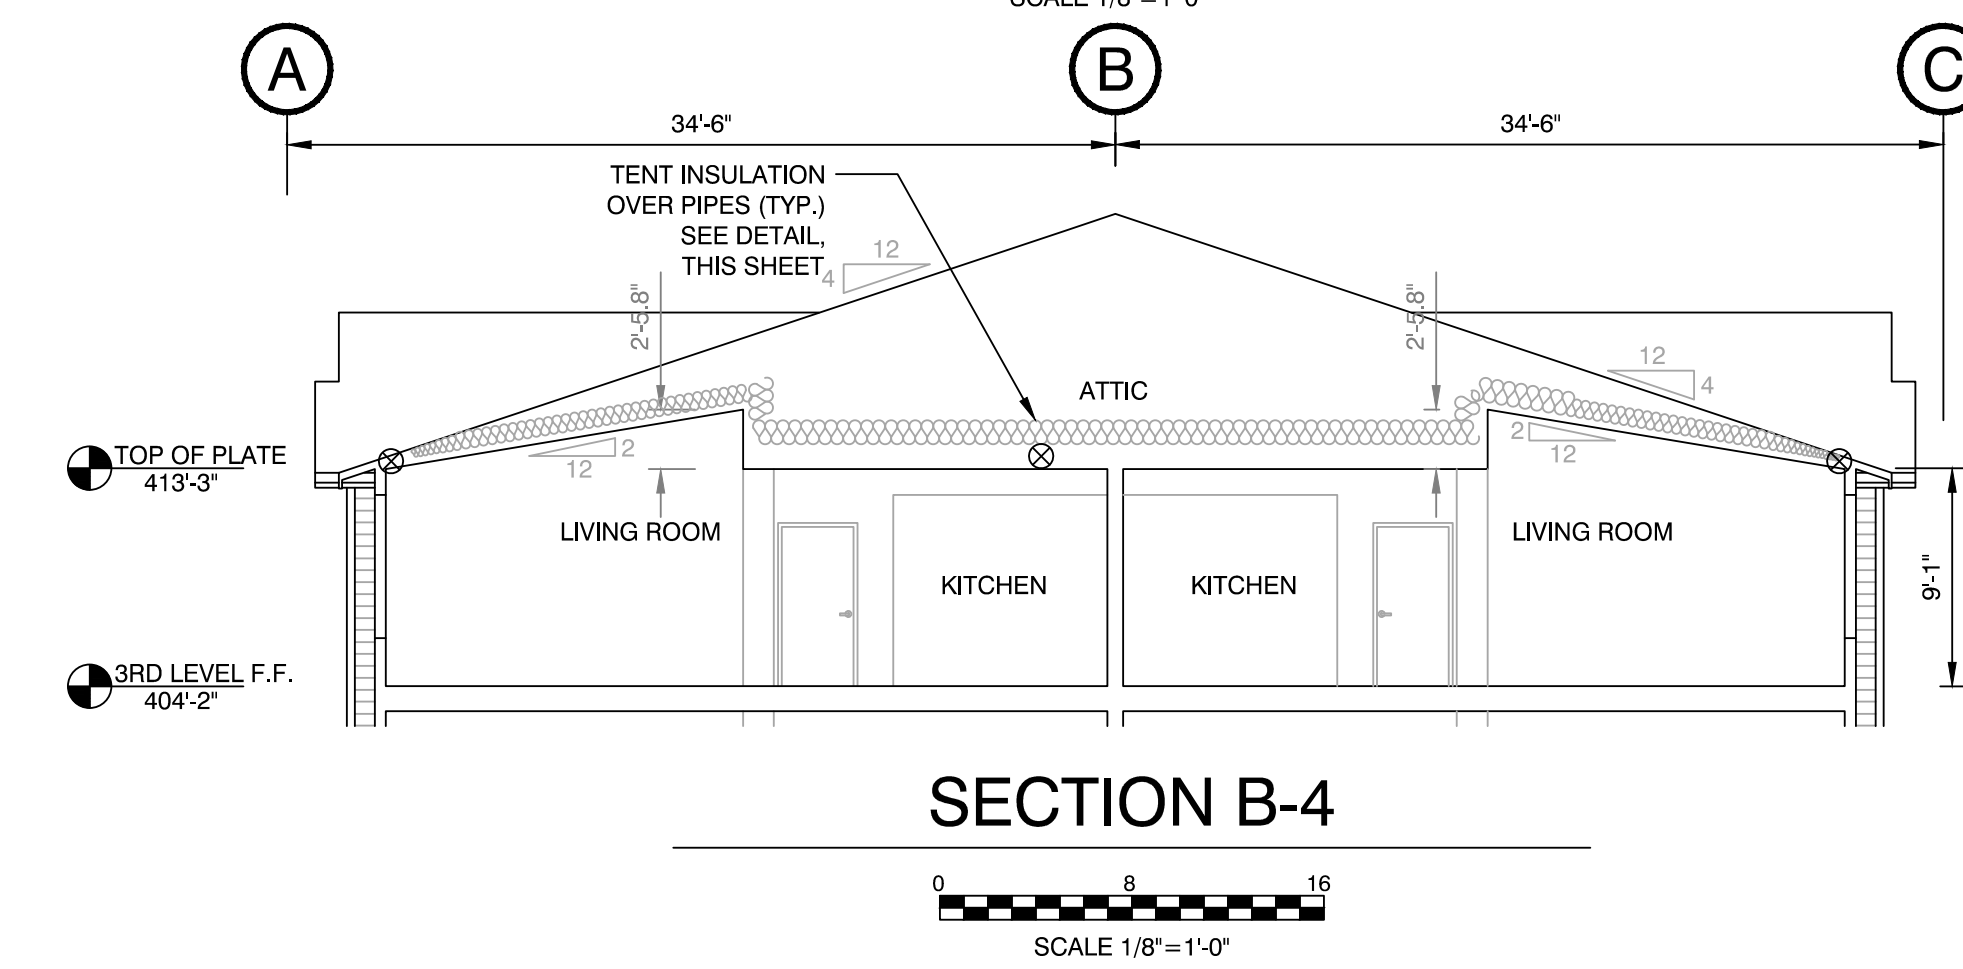

1. PRE-ENGINEERED WOOD TRUSS AT 24" O.C., TYP., U.N.O

ABBREVIATIONS

AFB	ABOVE FINISHED FLOOR
BOB	BOTTOM OF BEAM
BOJ	BOTTOM OF DECK
BOJ	BOTTOM OF JOIST
BOP	BOTTOM OF PURLIN
BOT	BOTTOM OF THUSS
CTO	CUT TO SUIT
FTO	FIELD ORDER
IFOW	INSIDE FACE OF WALL
OFOW	OUTSIDE FACE OF WALL
NO	NO AUTO. SPRINKLERS
UNO	UNLESS NOTED OTHERWISE

[illegible]

The logo for Washington State Fire Sprinkler Systems is located in the bottom left corner. It features a circular emblem with a stylized 'W' and the text 'Expires 12/15/25'. To the right of the emblem, the text 'WASHINGTON STATE CERTIFICATE OF COMPETENCY FIRE SPRINKLER SYSTEMS' is printed. Below this, the name 'Aaron Stewart Nelson' and the address '2345-1019-C Level 3 Smith Fire Systems, Inc. SMITHFS1360T' are listed. A signature is written over the name, and the date '12/05/2025' is printed to the right of the signature line.

CERTIFICATE OF COMPETENCY STATE

KEY PLAN

 SMITH FIRE SYSTEMS, INC.

DESIGNER	PROJECT MGR	DATE	SHEET	JOB NO.
A. RIDEOUT	N. GRASSI	12/04/25	4 OF 4	TC25207