




GENERAL NOTES  
 1. DIMENSIONS ARE TO FACE OF STUDS UNLESS NOTED OTHERWISE.

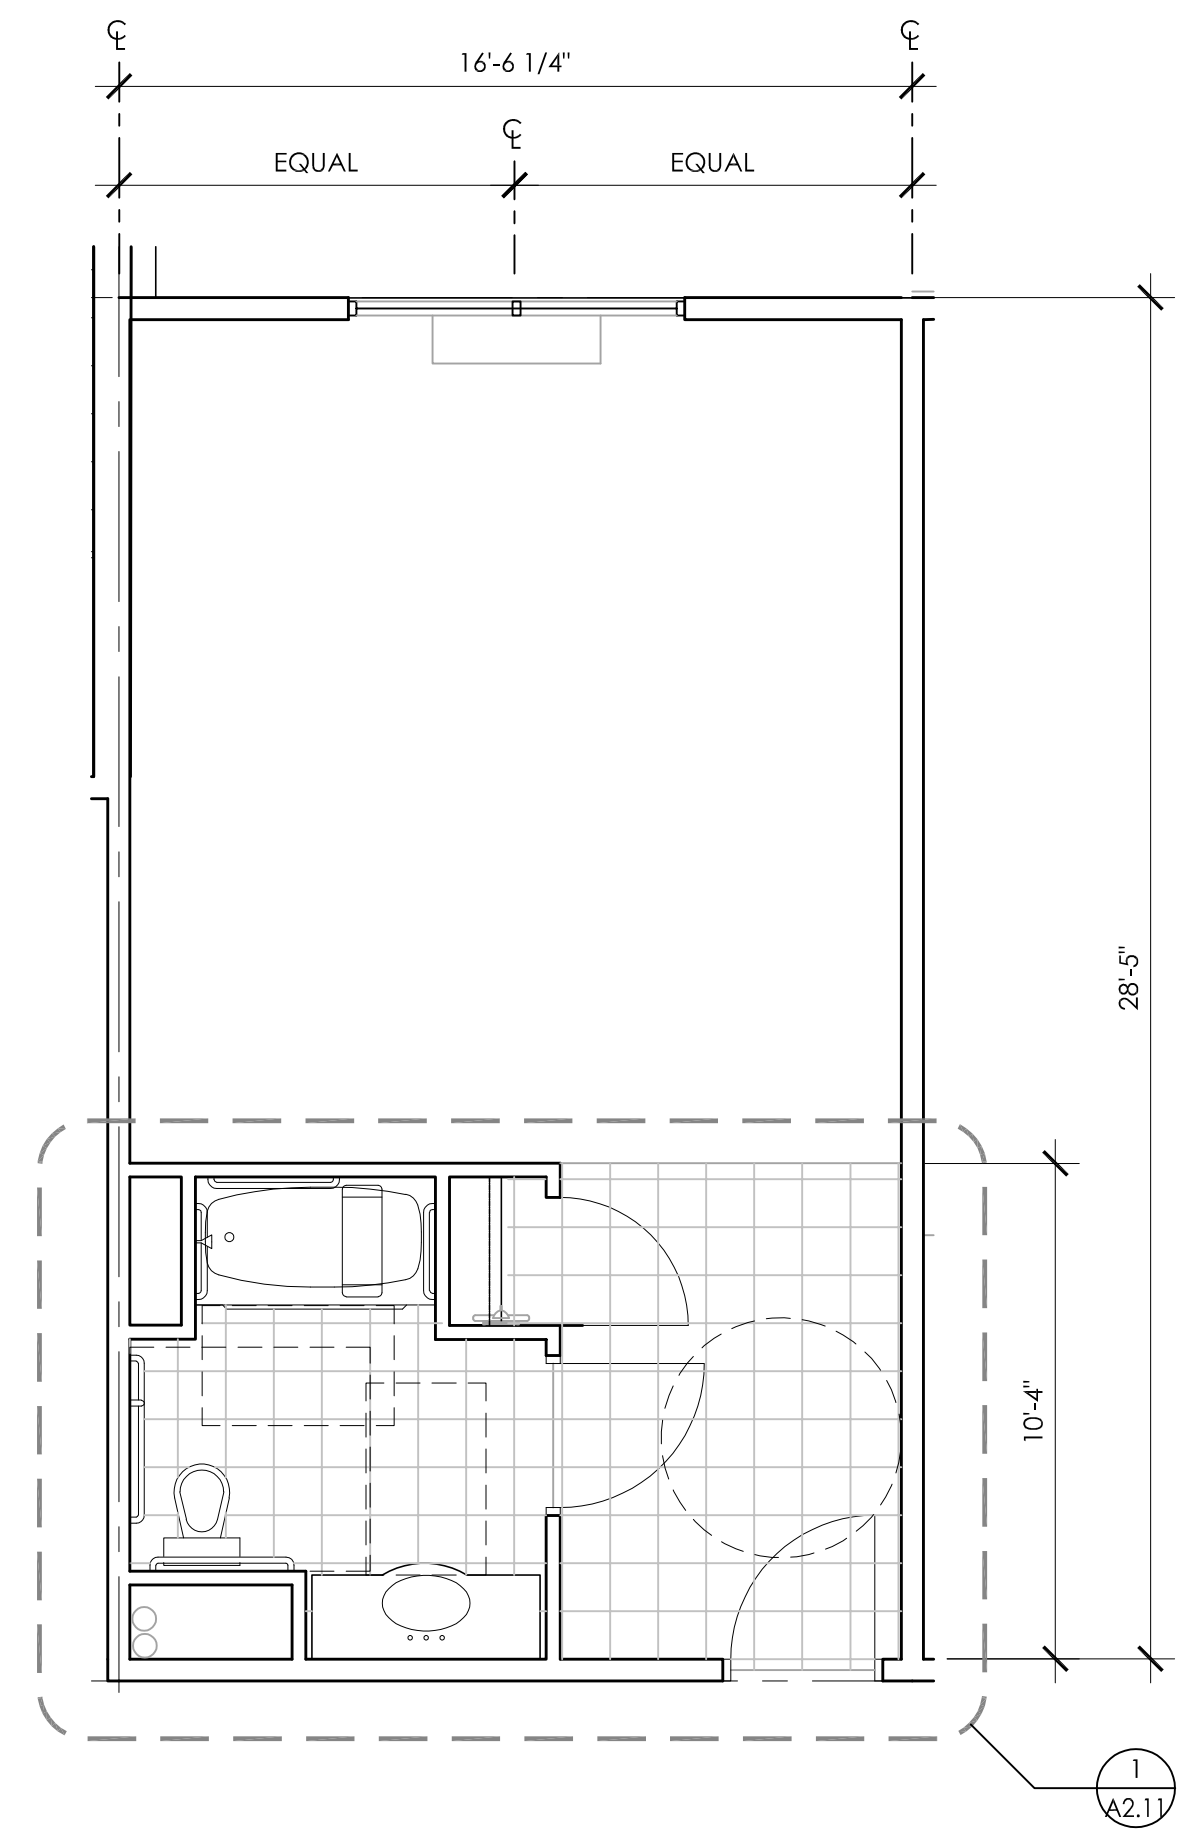


**1 ACCESSIBLE DOUBLE QUEEN**  
 24 x 36 - 1/4" = 1'-0"  
 12 x 18 - 1/8" = 1'-0"

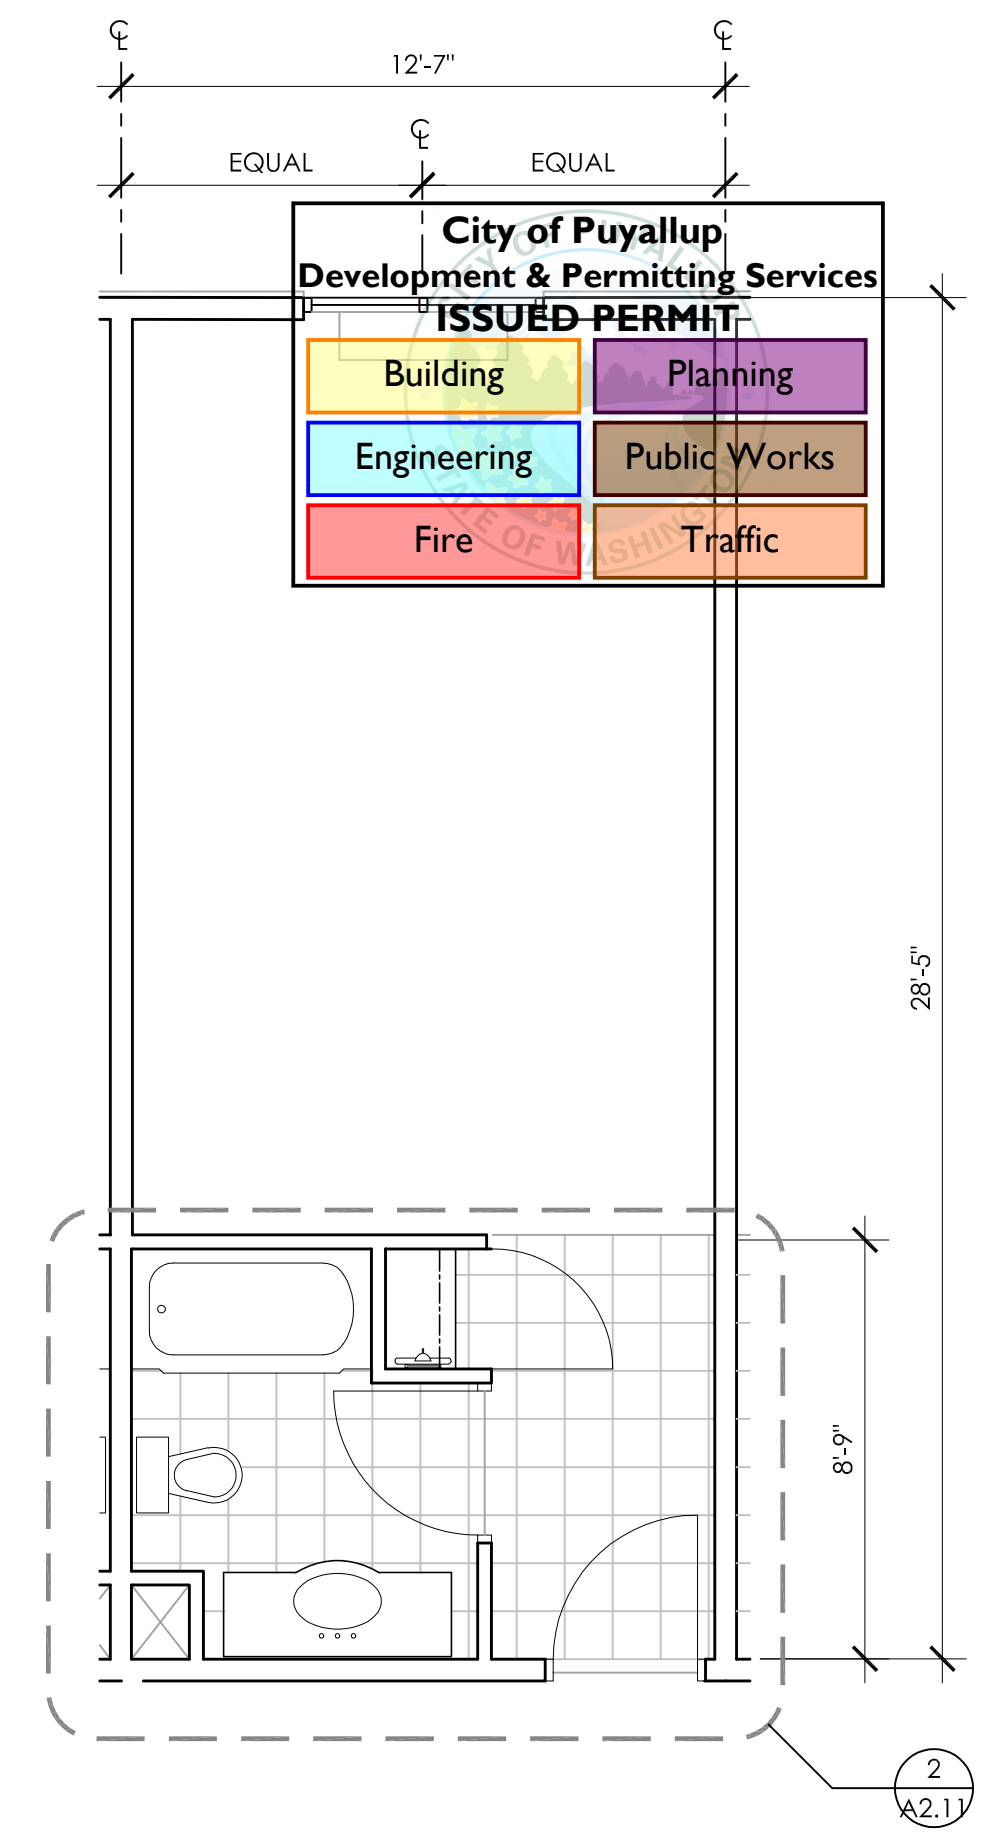

**2 TYPICAL DOUBLE QUEEN**  
 24 x 36 - 1/4" = 1'-0"  
 12 x 18 - 1/8" = 1'-0"

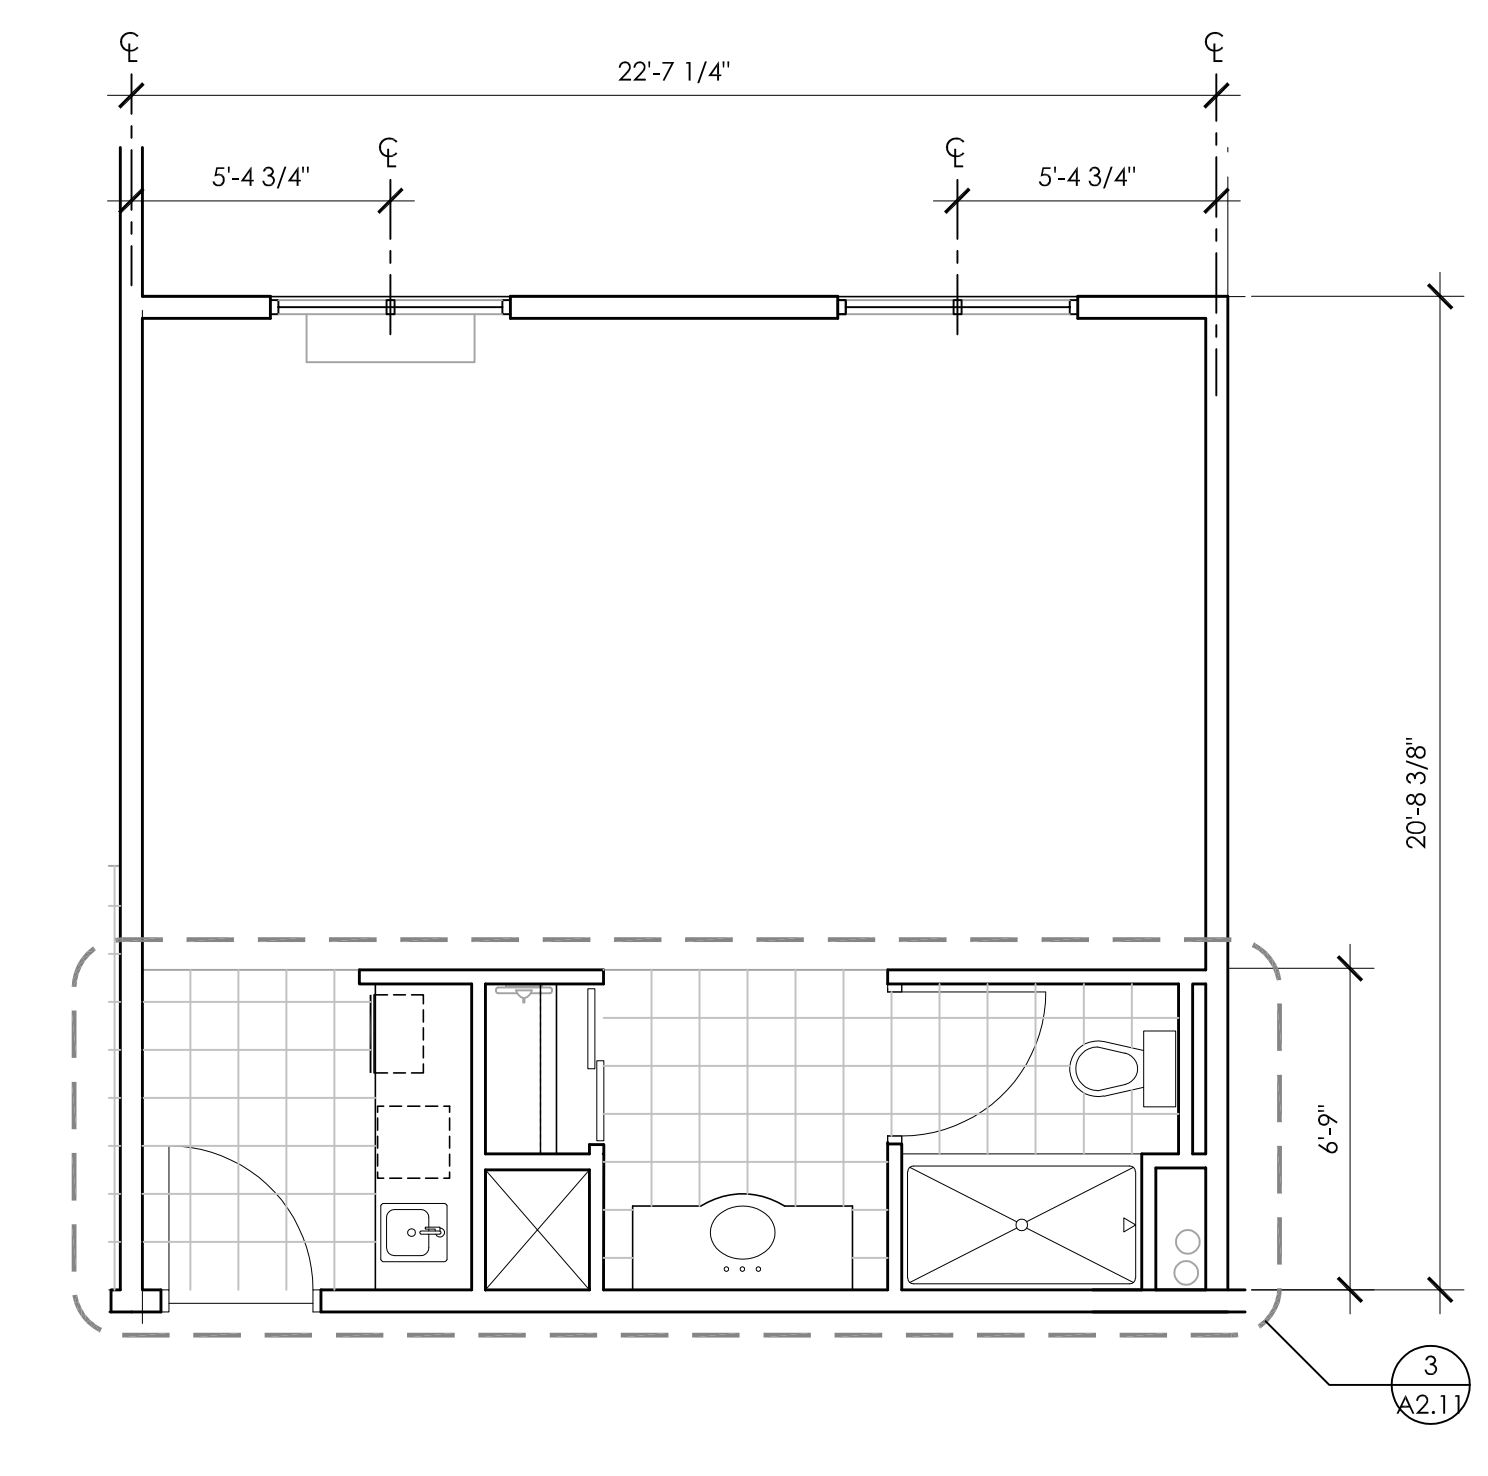

**3 KING STUDIO**  
 24 x 36 - 1/4" = 1'-0"  
 12 x 18 - 1/8" = 1'-0"

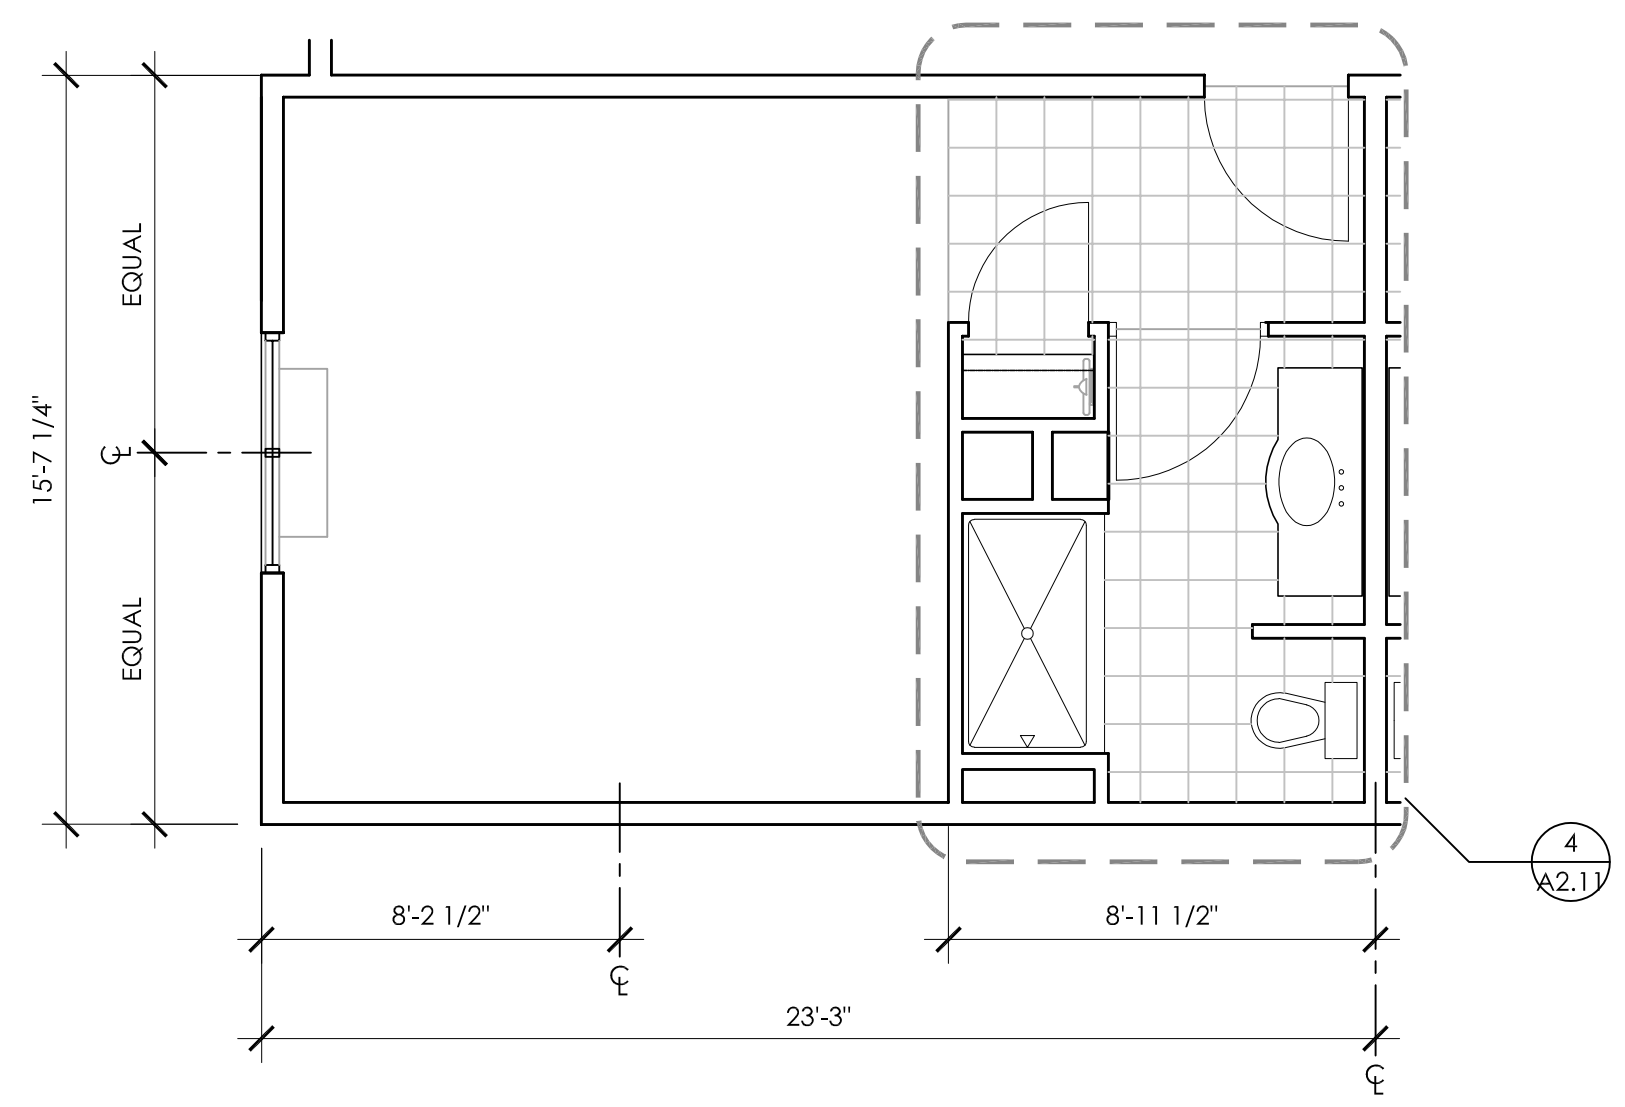

**4 TYPICAL KING**  
 24 x 36 - 1/4" = 1'-0"  
 12 x 18 - 1/8" = 1'-0"

ENLARGED GUEST ROOM PLANS



Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA

Job #:  
 Date: January 6, 2020  
 Revs:

# PUYALLUP HAMPTON INN ADDITION

1515 S. Meridian Street, Puyallup, WA 98371

## VICINITY MAP

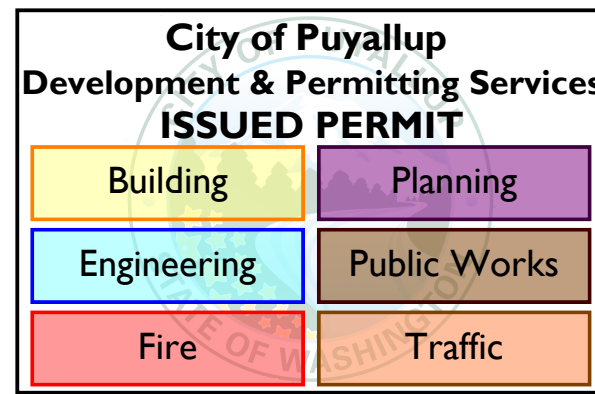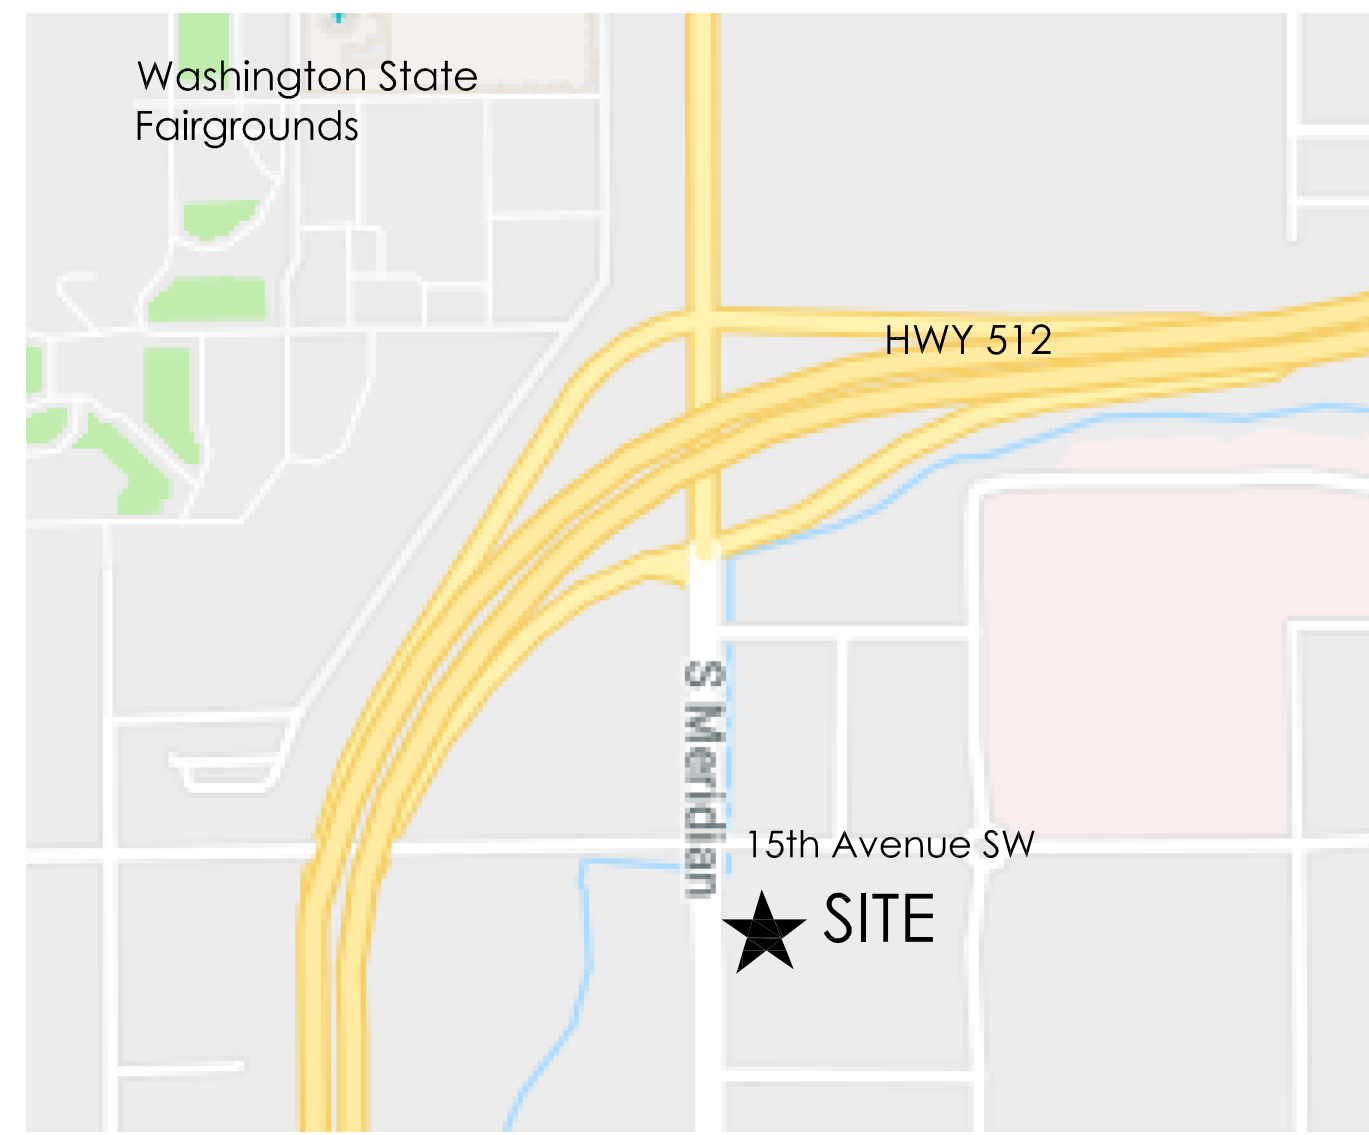

**B-20-0078**



**THE APPROVED CONSTRUCTION PLANS AND ALL ENGINEERING MUST BE POSTED ON THE JOB AT ALL INSPECTIONS IN A VISIBLE AND READILY ACCESSIBLE LOCATION.**

Approval of submitted plans is not an approval of omissions or oversight by this office or noncompliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable building codes and regulations of the local government.

## PROJECT TEAM

### OWNER

PVI, LLC  
11010 NE 8th ST SUITE 465  
BELLEVUE, WA 98444  
626-200-5019  
Contact: VICTOR SUNG

### STRUCTURAL ENGINEER

PCS Structural Solutions  
120 Pacific Avenue, Suite 701  
Tacoma, WA 98402  
253.383.2797  
Contact: Jared Plank, Project Eng.

### MECH./ELEC. ENGINEER

Abossein Engineering, Inc.  
18456 NE 68th Street  
Redmond, WA 98052  
425.462.9441  
Elec. Contact: Jay Werner  
Plumbing Contact: Dennis Grovenburg  
Mech. Contact: Gary Womack

### ARCHITECT

AustinCina Architects  
12202 Pacific Avenue S, Suite C  
Tacoma, WA 98444  
253.531.4300  
Contact: Neitha Wilkey, Project Architect

### CIVIL ENGINEER

Huitt-Zollars  
1102 Broadway, #301  
Tacoma, WA 98402  
253.627.9131  
Contact: Darton Riely-Gibbons

### LANDSCAPE ARCHITECT

Aspen Design Group  
P.O. Box 2394  
Issaquah, WA 98027  
425.292.9845  
Contact: Paul Dix

## PROJECT DATA

### SITE ADDRESS:

1515 MERIDIAN S.  
PUYALLUP, WA

### TAX PARCEL NUMBER:

7790000050 AND 7790000024

### ZONING:

ZONING: CG

### SITE AREA:

85,977 SF

### SCOPE OF WORK:

PARKING AREA EXPANSION BELOW NEW GUEST ROOM WING. NEW GUEST ROOM WING ADDITION OF 3 FLOORS. MINOR DEMOLITION OF ONE EXISTING GUEST ROOM ON EACH FLOOR TO PROVIDE ACCESS TO NEW WING.

### APPLICABLE EDITIONS OF BUILDING CODES:

2015 I.B.C. STATE AMENDMENTS AND WAC 51-50  
2015 INTERNATIONAL MECHANICAL CODE, STDS AND AMENDMENTS - WAC 51-52  
2015 INTERNATIONAL FIRE CODE, STDS AND AMENDMENTS - WAC 51-54  
2015 UNIFORM PLUMBING CODE, STDS AND AMENDMENTS - WAC 51-56, 51-57  
2010 ADA STANDARDS FOR ACCESSIBLE DESIGN & I.C.C. A117.1-2009  
2012 NON-RESEIDENTIAL ENERGY CODE

### OCCUPANCY CLASSIFICATION:

R1, S1, B, A3

### NUMBER OF STORIES:

4

### CONSTRUCTION TYPE:

V-A

### SPRINKLED

YES

FLOOR	EXISTING AREA	NEW AREA	TOTAL AREA
PARKING GARAGE	15,441 SF	0 SF	15,441 SF
1ST FLOOR	15,189 SF	168 SF	15,357 SF
2ND FLOOR	20,296 SF	4,484 SF	24,780 SF
3RD FLOOR	19,357 SF	4,484 SF	23,841 SF
4TH FLOOR	18,892 SF	4,484 SF	23,376 SF
	89,175 SF	13,620 SF	102,795 SF

## ABBREVIATIONS

A.B.	ANCHOR BOLT	L.	LENGTH
A.C.P.	ACOUSTICAL CEILING PANEL	MDF.	MEDIUM DENSITY FIBERBOARD
AFFLR.	ABOVE FINISH FLOOR	MTL.	METAL
ADD. ALT.	ADDITIVE ALTERNATE	N.I.C.	NOT IN CONTRACT
B.F.	BARRIER FREE	N.T.S.	NOT TO SCALE
B.S.	BACK SPLASH	O.C.	ON CENTER
BM.	BEAM	O.H.	OPPOSITE HAND/OVER HANG
C.J.	CONTROL/CONSTRUCTION JOINT	OPT.	OPTIONAL
C.L. or C	CENTERLINE	O.S.B.	ORIENTED STRAND BOARD
CONT.	CONTINUOUS	P.L.B.	PARA LAMINATED BEAM
CPT.	CARPET	P.LAM.	PLASTIC LAMINATED
CRM.	CLASSROOM	PLYWD.	PLYWOOD
C.T.	Ceramic Tile	PR.	PAIR
D.	DEPTH	PT.	PAINT
D.F.	DRINKING FOUNTAIN	P.T.D.	PAPER TOWEL DISPENSER
D.O.	DEDICATED OUTLET	R.B.	RUBBER BASE
D.S.	DOWN SPOUT	R.D.	ROOF DRAIN
E.C.	EXPOSED CONCRETE	R.I.	ROUGH-IN
EXIST.	EXISTING	R.L.	RAIN LEADER
EXP. BOLT	EXPANSION BOLT	R.S.	ROUGH SAWN
FDN.	FOUNDATION	S & V	STAINED & VARNISHED
F.D.	FLOOR DRAIN	S.C.	SOLID CORE
F.E.	FIRE EXTINGUISHER	S.V.	SHEET VINYL
FIN. FLR.	FINISH FLOOR	SHT. MTL.	SHEET METAL
F.O.I.C.	FURNISHED BY OWNER INSTALLED BY GC.	SIM.	SIMILAR
F.O.I.O	FURNISHED BY OWNER INSTALLED BY OWNER	T & G	TONGUE & GROOVE
F.O.P.W	FACE OF PLYWOOD	T.O.C	TOP OF CONCRETE
F.R.P.	FIBERGLASS REINFORCED PANEL	T.O.P.	TOP OF PLATE
G.LAM/GL	GLUE LAMINATED	T.O.W.	TOP OF WALL
GA.	GAUGE OR GAGE	TRT.	TREATED
GALV.	GALVANIZED	T.S.	TUBE STEEL
GWB.	GYPSPUM WALL BOARD	T.T.D.	TOILET TISSUE DISPENSER
GYP.	GYPSPUM	TYP.	TYPICAL
H.	HEIGHT	U.N.O.	UNLESS NOTED OTHERWISE
H.C.	HOLLOW CORE/HANDICAP	W.O.M.	WALK OFF MAT
H.M.	HOLLOW METAL	W.	WIDE
HDR.	HEADER	W.P.	WATER PROOF
		WD.	WOOD
		WDW.	WINDOW

## SYMBOLS

	Room Number		Interior Elevation Group Sheet Number
	Window Type		Wall Section Number Sheet Number
	Door Number		Bldg. Section Number Sheet Number
	Datum, Work, or Control Point		Detail Number Sheet Number
	Shear Wall Type		

## GENERAL NOTES

- ALL WORK SHALL CONFORM TO APPLICABLE CURRENT FEDERAL, STATE AND LOCAL CODES. THE CONTRACTOR IS TO PROVIDE FOR ALL REQUIRED NOTIFICATION OF AND COORDINATION WITH CITY AND STATE AGENCIES, AND PROVIDE REQUIRED PERMITS. ALL TESTS AND INSPECTIONS ASSOCIATED WITH OBTAINING APPROVALS TO PROCEED WITH AND COMPLETE THE WORK SHALL BE PAID FOR BY THE CONTRACTOR.
- THE CONTRACTOR SHALL COORDINATE ALL OPERATIONS WITH THE OWNER, INCLUDING AREA FOR WORK, MATERIALS STORAGE, AND ACCESS TO AND FROM THE WORK. SPECIAL CONDITIONS OR NOISY WORK, TIMING OF WORK AND INTERRUPTION OF MECHANICAL AND ELECTRICAL SERVICES. NOISY OR DISRUPTIVE WORK SHALL BE SCHEDULED AT LEAST ONE (1) WEEK IN ADVANCE OF THE TIME WORK IS TO COMMENCE.
- ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE HIGHEST STANDARD OF WORKMANSHIP IN GENERAL AND WITH SUCH STANDARDS AS ARE SPECIFIED.
- CONTRACTOR SHALL ADHERE TO ALL BUILDING STANDARDS. ANY CHANGES TO SAME SHALL BE SUBMITTED TO ARCHITECT IN WRITING FOR APPROVAL.
- CONTRACTOR SHALL SUBMIT SAMPLES OF ALL FINISHES OF SUCH SIZE AND NUMBER THAT THEY REPRESENT A REASONABLE DISTRIBUTION OF COLOR RANGES AND PATTERN PRIOR TO INSTALLATION FOR OWNER'S APPROVAL. CONTRACTOR SHALL PROVIDE SHOP DRAWINGS AND PRODUCT DATA FOR ARCHITECT'S APPROVAL ON ALL SPECIAL ITEMS REQUIRING CUSTOM FABRICATION.
- CONTRACTOR IS TO VERIFY ALL DIMENSIONS AND CONDITIONS ON SITE AND NOTIFY ARCHITECT OF ANY DISCREPANCIES. CONTRACTOR IS NOT TO SCALE OFF DRAWINGS.
- CONTRACTOR SHALL PROVIDE BLOCKING/BACKING IN PARTITIONS FOR ALL WALL-MOUNTED FIXTURES AND DEVICES UNLESS INDICATED OTHERWISE ON THE DRAWINGS.
- ALL FLOORS SHOULD BE LEVEL AND NOT VARY MORE THAN 1/4" IN 10'-0". THE CONTRACTOR SHALL NOTIFY ARCHITECT OF ANY CONDITIONS THAT DO NOT MEET THIS STANDARD.
- FLOOR FINISH TRANSITIONS SHALL OCCUR UNDER DOORS, UNLESS SHOWN OR NOTED OTHERWISE.
- MATERIALS, ARTICLES, DEVICES AND PRODUCTS ARE SPECIFIED IN THE DOCUMENTS BY LISTING ACCEPTABLE MANUFACTURERS OR PRODUCTS, BY REQUIRING COMPLIANCE WITH REFERENCED STANDARDS, OR BY PERFORMANCE SPECIFICATIONS. FOR ITEMS SPECIFIED BY NAME, SELECT ANY PRODUCT NAMED. FOR THOSE SPECIFIED BY REFERENCE STANDARDS OR BY PERFORMANCE SPECIFICATIONS SELECT ANY PRODUCT MEETING OR EXCEEDING SPECIFIED CRITERIA. FOR APPROVAL OF AN ITEM NOT SPECIFIED, SUBMIT REQUIRED SUBMITTALS, PROVIDING COMPLETE BACK-UP INFORMATION FOR PURPOSES OF EVALUATION. WHERE BUILDING STANDARD ITEMS ARE CALLED FOR, NO SUBSTITUTE WILL BE ACCEPTED.
- CONTRACTOR SHALL PROVIDE FOR ALL WORK REQUIRED TO MAINTAIN COMPLIANCE WITH LOCAL FIRE CODE. PROVIDE FOR ALL REQUIRED SHOP DRAWINGS AND APPROVALS. CONTRACTOR IS RESPONSIBLE FOR PROVIDING FIRE ALARM SYSTEM AUDIBILITY.
- MECHANICAL AND ELECTRICAL FIXTURES, OUTLETS, ETC., WHEN SHOWN ON THE ARCHITECTURAL DRAWINGS, ARE FOR LOCATION INFORMATION ONLY. MECHANICAL AND ELECTRICAL TO BE DESIGNED BY OTHERS. ALL CIRCUITING COORDINATION TO BE BY OTHERS.

Refer to approved civil plan: **E-20-0052** for sedimentation and erosion control methods

Control of roof downspouts is required. Refer to approved civil plans for control methods: **E-20-0052**

APPROVED PLAN  
CITY OF PUYALLUP  
PLANNING DIVISION

APPROVED BY: CBeale

DATE: 08/06/2020

CASE NO.:

CONDITIONS:


Setback to 15th Ave. 12' min.

## INDEX TO DRAWINGS

A0.1	COVER SHEET AND PROJECT INFORMATION	S2.0	FOUNDATION PLAN
C1.0	COVER, VICINITY LEGEND & MAP	S2.1	LEVEL2 FRAMING PLAN
C1.1	GENERAL NOTES	S2.1A	LEVEL 2 BOTTOM & TOP REINFORCING PLANS
C1.2	OVERALL SITE PLAN	S2.2	LEVEL3 FRAMING PLAN
C2.0	DEMOLITION PLAN	S2.3	LEVEL4 FRAMING PLAN
C3.0	TEMPORARY EROSION AND SEDIMENT CONTROL PLAN	S2.4	ROOF FRAMING PLAN
C3.1	TESC NOTES AND DETAILS	S3.1	FOUNDATION DETAILS
C4.0	GRADING & DRAINAGE PLAN	S3.2	FOUNDATION DETAILS
C4.1	GRADING CROSS SECTIONS	S3.3	FOUNDATION DETAILS
C4.2	GRADING & DRAINAGE & DETAILS	S3.4	CONCRETE STUD RAIL DETAILS
C5.0	SITE PAVING & UTILITY PLAN	S3.5	FOUNDATION DETAILS
C5.1	SITE PAVING & UTILITY DETAILS	S4.0	WOOD FRAMING DETAILS
C5.2	SITE PAVING & UTILITY DETAILS	S4.1	WOOD FRAMING DETAILS
C5.3	SITE PAVING & UTILITY DETAILS	S4.2	WOOD FRAMING DETAILS
C6.0	RIGHT-OF-WAY/FRONTAGE IMPROVEMENTS	S4.3	WOOD FRAMING DETAILS
C6.1	RIGHT-OF-WAY/FRONTAGE IMPROVEMENTS DETAILS	S5.0	WOOD FRAMING DETAILS
S1.0	SURVEY	S6.0	ROOF FRAMING DETAILS
L1.0	LANDSCAPE PLAN	M1.0	GENERAL NOTES, SCHEDULES AND LEGENDS
L2.0	LANDSCAPE DETAILS	M2.0	2ND LEVEL FLOOR PLAN - HVAC
A0.2	CODE INFORMATION	M3.0	3RD LEVEL FLOOR PLAN - HVAC
A0.3	WALL AND FLOOR-CLG TYPES	M4.0	4TH LEVEL FLOOR PLAN - HVAC
A0.4	FIRE RATED PENETRATIONS	M5.0	ROOF PLAN - HVAC
A1.1	OVERALL SITE PLAN	M6.0	MECHANICAL DETAILS
A2.1	1ST FLOOR PLAN SELECTIVE DEMOLITION - FIRST FLOOR	M7.0	SPECIFICATIONS
A2.2	2ND FLOOR PLAN SELECTIVE DEMO PLAN - 2ND FLOOR	P1.0	GENERAL NOTES, SCHEDULES AND LEGEND
A2.3	3RD FLOOR PLAN SELECTIVE DEMO PLAN - 3RD FLOOR	P2.0	1ST FLOOR PLAN - PLUMBING
A2.4	4TH FLOOR PLAN SELECTIVE DEMO PLAN - 4TH FLOOR	P3.0	2ND FLOOR PLAN - PLUMBING
A2.5	ROOF PLAN	P4.0	3RD FLOOR PLAN - PLUMBING
A2.6	1ST FLOOR REFLECTED CEILING PLAN	P5.0	4TH FLOOR PLAN - PLUMBING
A2.7	2ND FLOOR REFLECTED CEILING PLAN	P6.0	ROOF PLAN - PLUMBING
A2.8	3RD FLOOR REFLECTED CEILING PLAN	P7.0	RISER DIAGRAMS PLUMBING
A2.9	4TH FLOOR REFLECTED CEILING PLAN	P9.0	PLUMBING SPECIFICATIONS
A2.10	ENLARGED GUEST ROOM PLANS	E1.0	GENERAL NOTES, SCHEDULES AND PLAN INDEX
A2.11	ENLARGED BATHROOM PLANS	E2.0	1ST FLOOR POWER
A2.12	ENLARGED STAIR PLANS	E2.1	2ND FLOOR POWER
A2.13	BATHROOM ELEVATIONS	E2.2	3RD FLOOR POWER
A3.1	EXTERIOR ELEVATIONS	E2.3	4TH FLOOR POWER
A3.2	EXTERIOR ELEVATIONS	E2.4	ROOF PLAN - POWER
A4.1	BUILDING SECTIONS	E3.0	1ST FLOOR LIGHTING
A4.2	BUILDING SECTIONS	E3.1	2ND FLOOR LIGHTING
A5.1	WALL SECTIONS	E3.2	3RD FLOOR LIGHTING
A6.1	DOOR SCHEDULE	E3.3	4TH FLOOR LIGHTING
A6.2	WINDOW SCHEDULE	E4.0	ENLARGED UNIT PLANS ELECTRICAL
A7.1	EXTERIOR DETAILS	E5.0	POWER RISER DIAGRAM LEVELS 1-4
A7.2	DETAILS	E5.1	TELECOMMUNICATION RISER DIAGRAM
A7.3	ROOF DETAILS	E5.2	FIRE ALARM RISER DIAGRAM AND NOTES
S1.0	GENERAL NOTES	E6.0	DETAILS
S1.1	GENERAL NOTES	E7.0	PANEL SCHEDULES
S1.2	GENERAL NOTES	E7.1	PANEL SCHEDULES
S1.3	GENERAL NOTES	E8.0	ENERGY CODE FORMS
		E8.1	ENERGY CODE FORMS
		E9.0	MECHANICAL EQUIPMENT SCHEDULES
		E9.1	FAULT CURRENT & ARC FLASH SCHEDULE
		E10.0	SPECIFICATIONS



12202 Pacific Ave. Suite C  
Tacoma, Washington 98444  
P: 253.531.4300 F: 253.537.6542  
E: architects@austincina.com

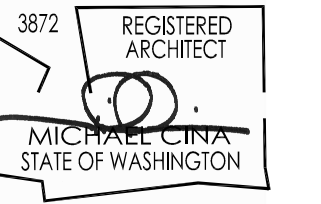


COVER SHEET AND PROJECT INFORMATION


Addition to Hampton Inn & Suites  
Hampton Inn & Suites  
1515 S. Meridian, Puyallup, WA

Job #:  
Date: January 6, 2020  
Revs:


A0.1  
PERMIT SET

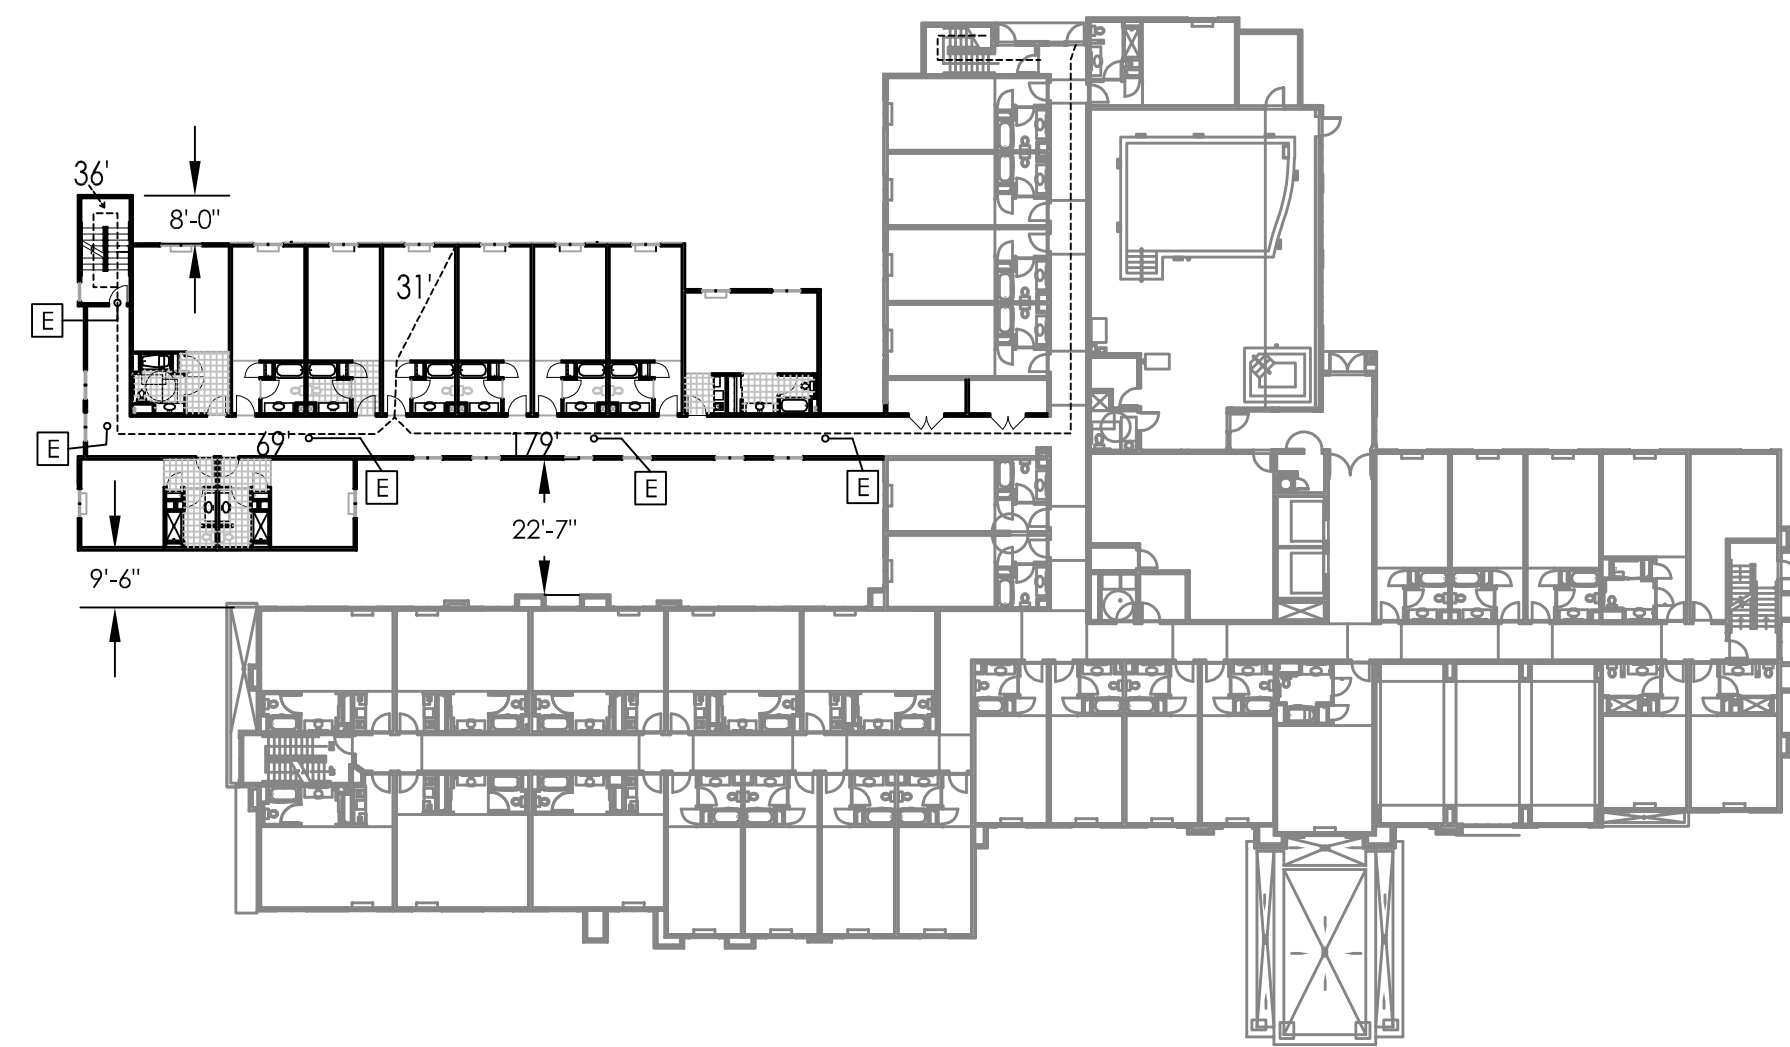


3 SECOND FLOOR  
SCALE: 1/32" = 1'-0"

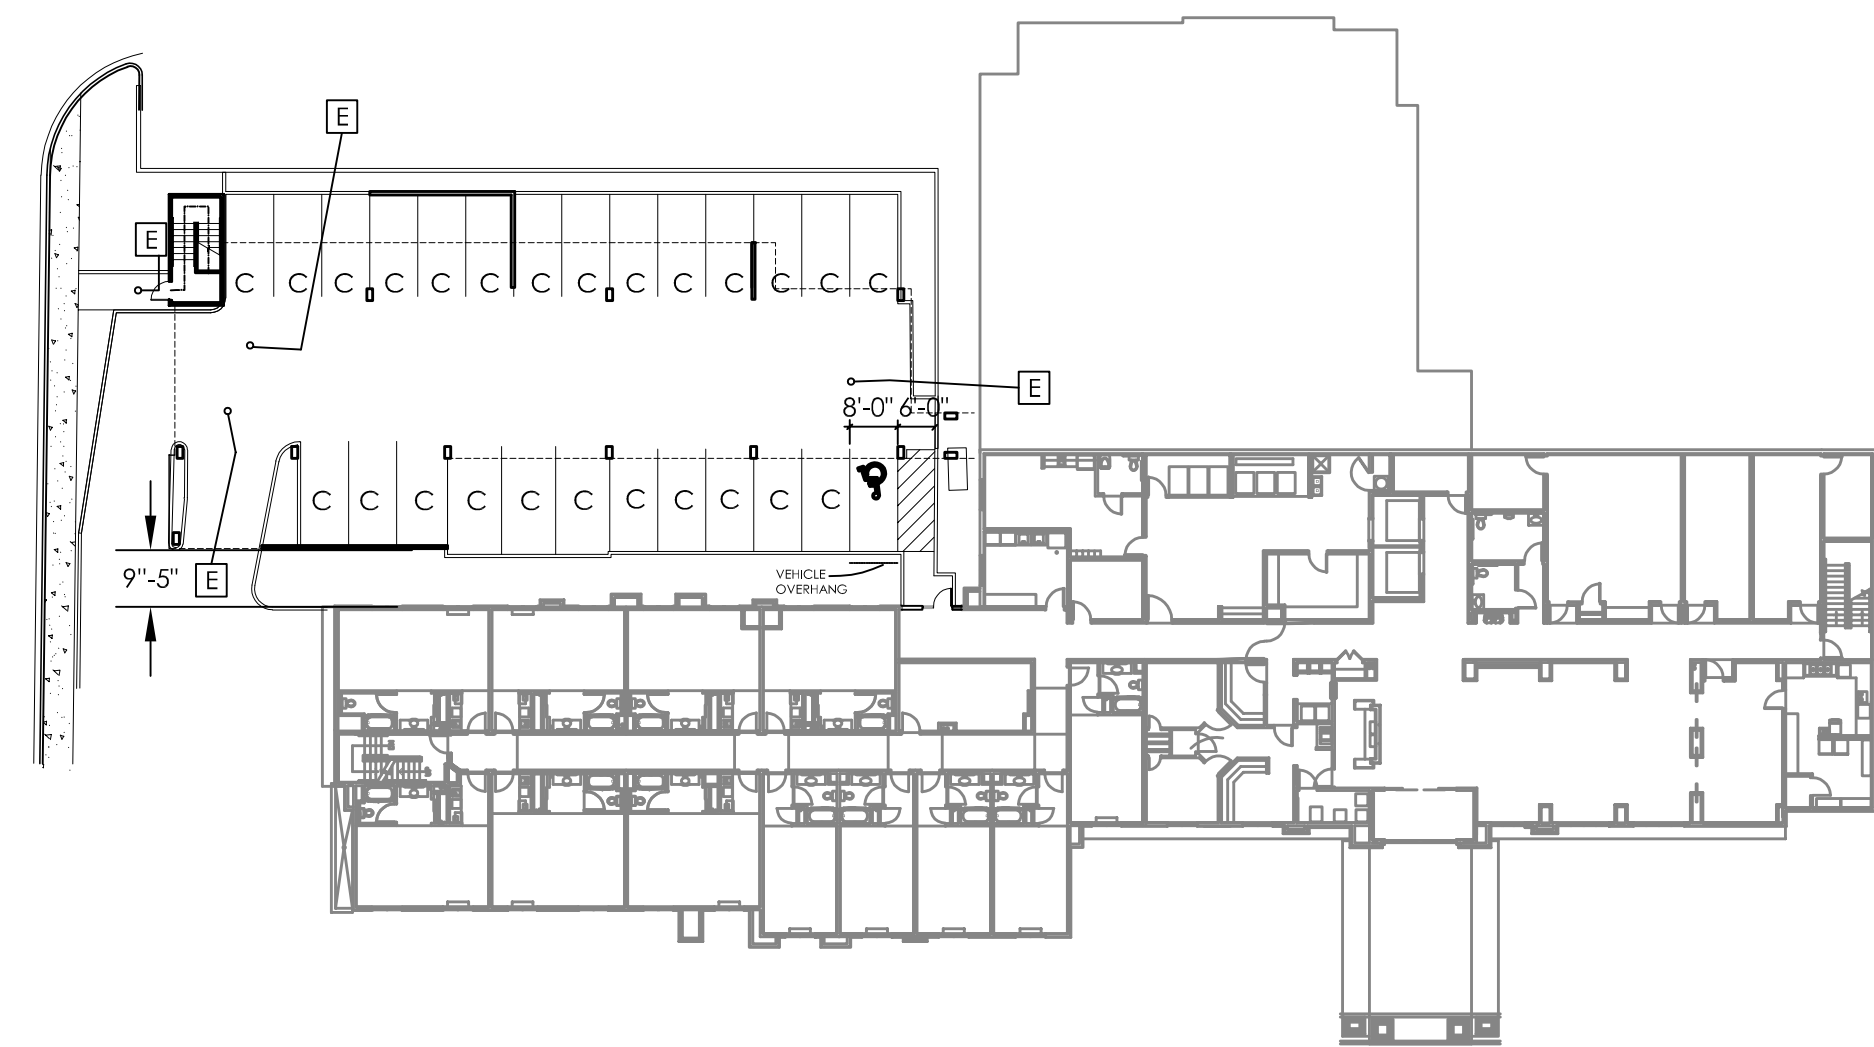


2 FIRST FLOOR  
SCALE: 1/32" = 1'-0"

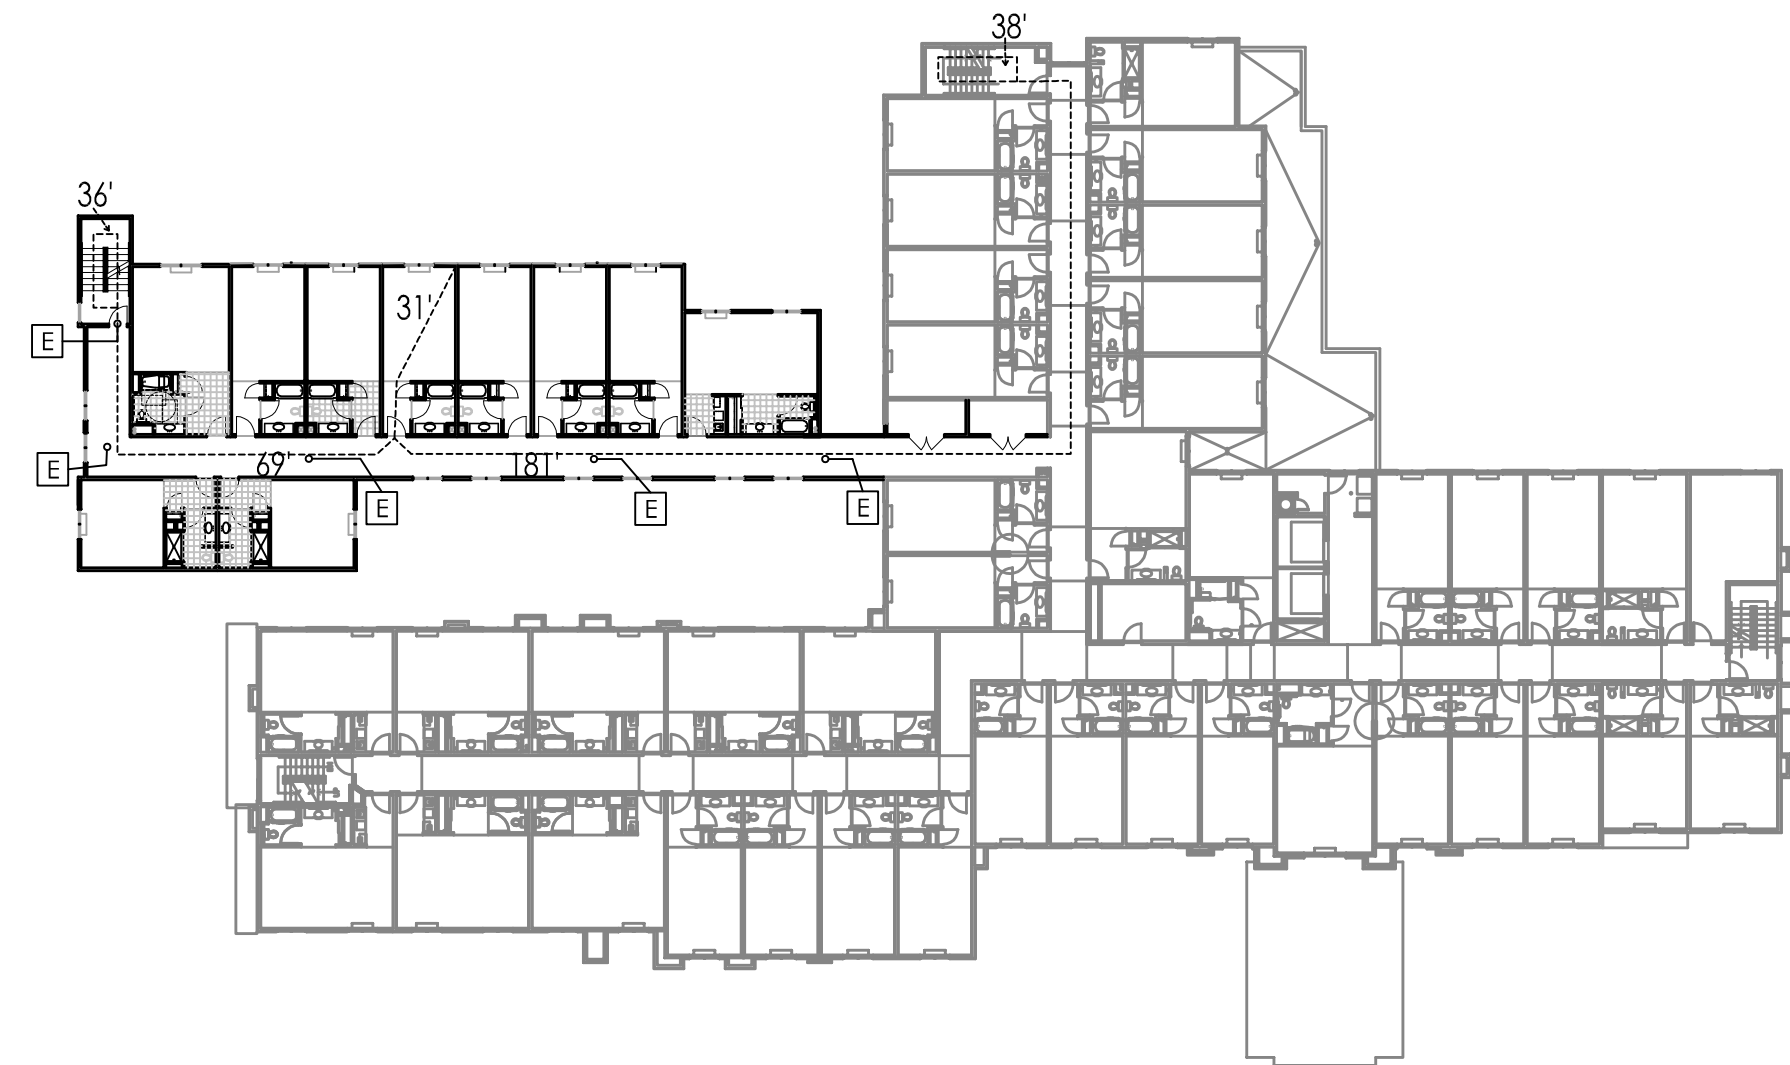

4 THIRD FLOOR  
SCALE: 1/32" = 1'-0"

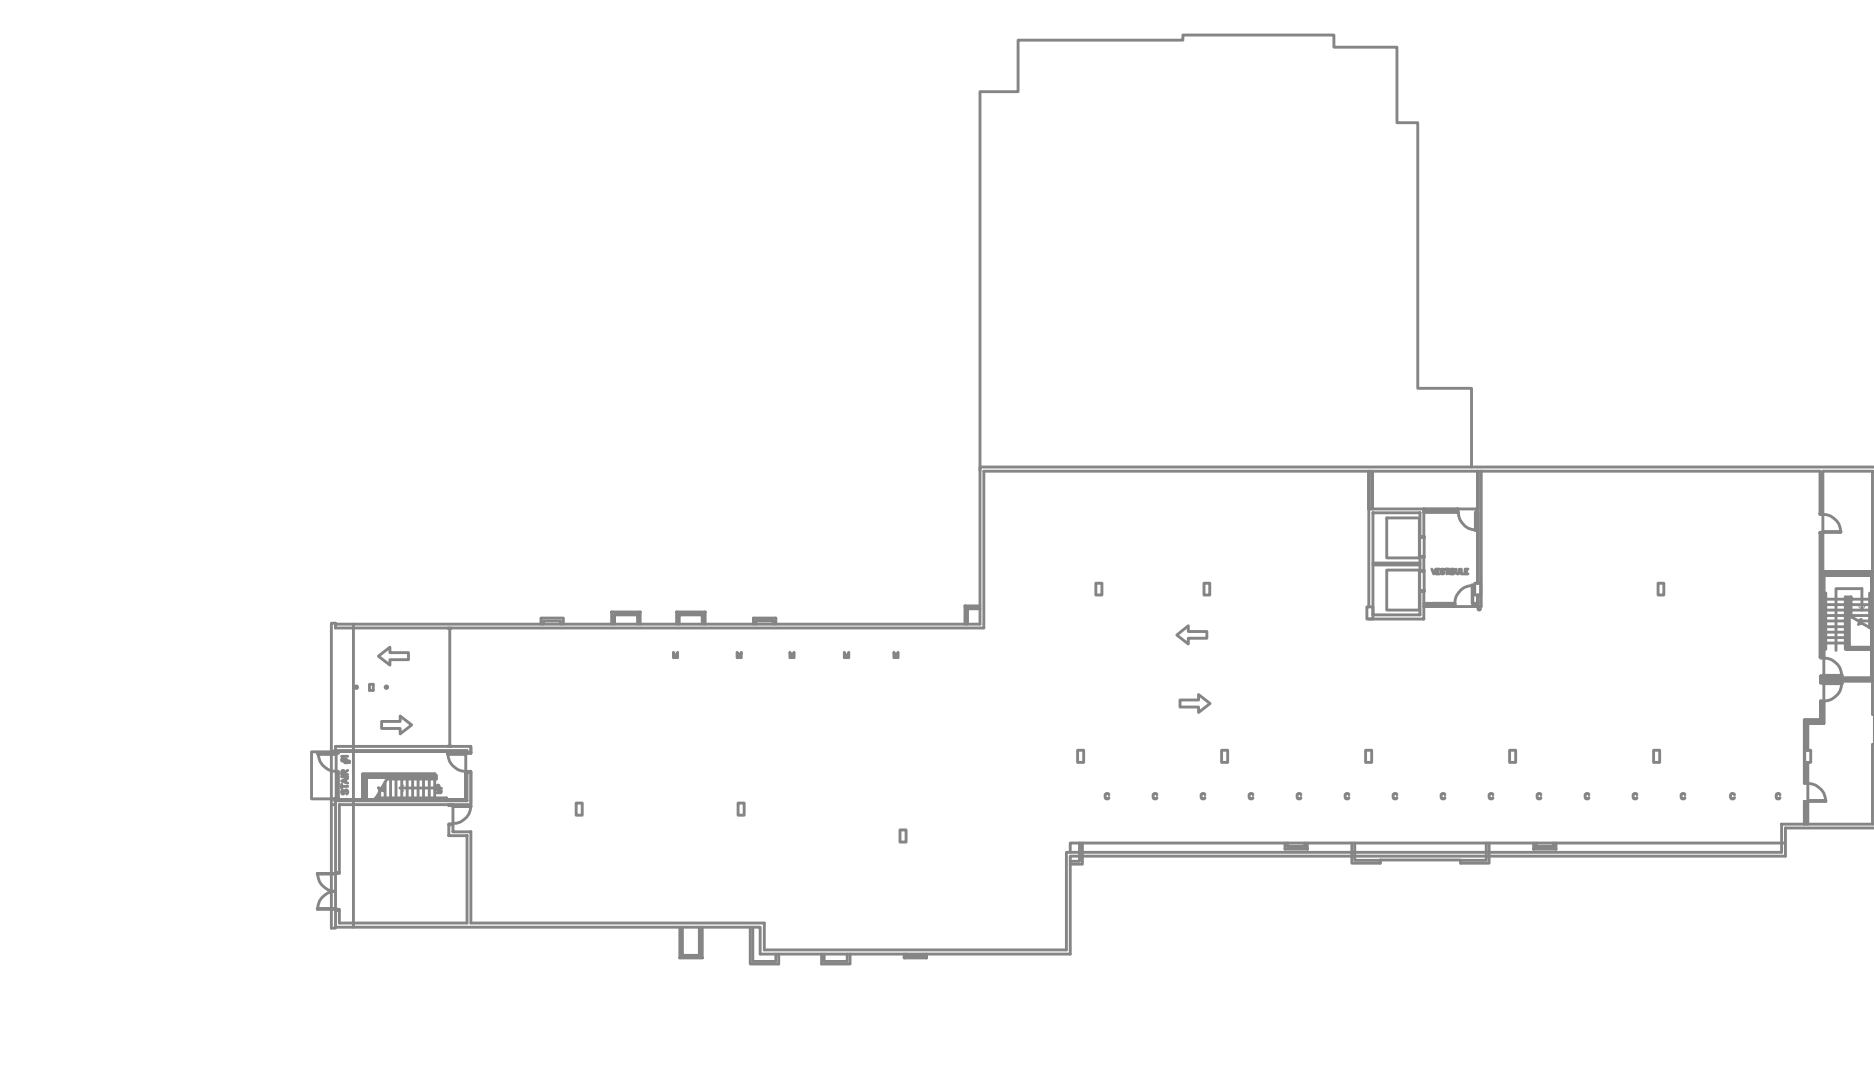

1 PARKING LEVEL  
SCALE: 1/32" = 1'-0"

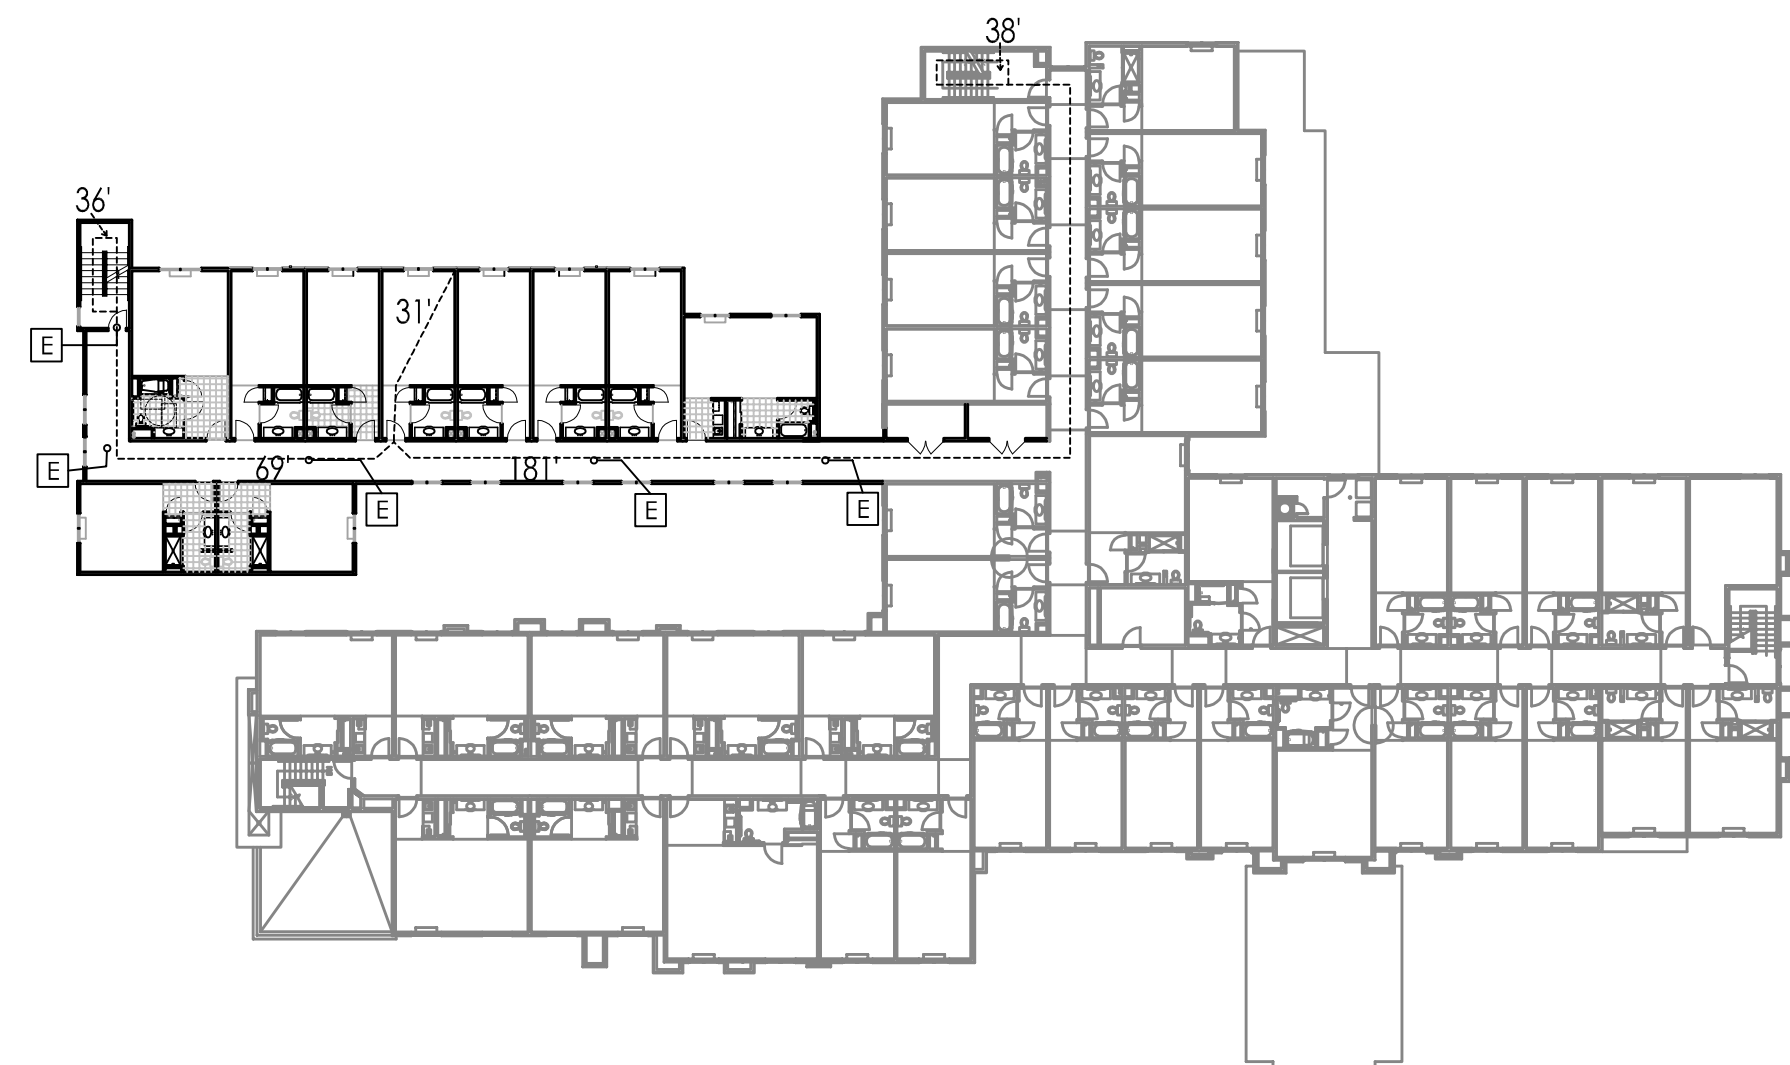

5 FOURTH FLOOR  
SCALE: 1/32" = 1'-0"

MIXED USE CALCULATION

Occup.	Existing	New	Total	Allowable Area/Floor	Allowable Floors	Total Area Allowable	Ratio	Sprinklers	Const. Type
R1	64,214	13,452	77,666	36,000	4	144,000	0.54	Yes	V-A
B	9,440	0	9,440	54,000	4	216,000	0.04	Yes	V-A
A3	1,889	0	1,889	34,500	3	103,500	0.02	Yes	V-A
S1	15,026	7,385	22,411	63,000	5	315,000	0.07	Yes	II-A

LEGEND  
E - EXIT SIGN  
SEE ELECTRICAL FOR DETAILS

City of Puyallup  
Development & Permitting Services  
ISSUED PERMIT

Building	Planning
Engineering	Public Works
Fire	Traffic

EGRESS REQUIREMENTS

REQUIRED WIDTH 1005.3.1 AND 1005.3.2  
EXIT WIDTH: 482(2) = 96.4" PROVIDED: 352"

TABLE 1006.3.1 MIN. EXITS REQUIRED PER STORY:  
REQUIRED: 2 PROVIDED: 11

FLOOR	DIA. DIST.	REQ. SEPARATION
FIRST	407 LF	136 LF (1/3)

OCC.	SPRINKLED	MAX. DIST.	PROVIDED
R1	YES	250 LF	181 L.F. OR LESS

ACCESSIBLE UNITS - ADDITION ONLY

T1107.6.1.1	REQUIRED W/O ROLL-IN SHOWER	REQUIRED W/ ROLL-IN SHOWER	PROVIDED
26-50 UNITS	2	0	3
2ND FLOOR	1 DOUBLE QUEEN		
3RD FLOOR	1 DOUBLE QUEEN		
4TH FLOOR	1 DOUBLE QUEEN		

WSEC

ANY CHANGES TO UNITS OR MATERIALS CALLED OUT ON DRAWINGS MAY AFFECT COMPLIANCE WITH WSEC 2015. VERIFY COMPLIANCE WITH NREC FORMS AND THE COMPLIANCE PATH.

CLIMATE ZONE: 4-C (MARINE)  
COMPLIANCE PATH: PRESCRIPTIVE  
HEAT SOURCE: ELEC. HEAT PUMP

BUILDING ENVELOPE

ROOF: R-38  
WALLS - WOOD FRAMED: R-21 INT  
SLAB ON GRADE: R-10  
DOORS, SWINGING: U = .37  
WINDOWS: U = .39

INSULATION NOTES

- ALL INSULATION TO BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS TO ACHIEVE THE R-VALUE OF THE INSULATION PRODUCT.
- ALL INSULATION TO BEAR MANUFACTURER'S R-VALUE LABEL AND R-VALUE LABEL SHALL BE READILY VISIBLE UPON INSPECTION.
- INSULATION INSTALLERS SHALL PROVIDE CERTIFICATION LISTING THE TYPE, MANUFACTURER, AND R-VALUE OF INSULATION INSTALLED AND SHALL SIGN, DATE AND POST CERTIFICATION IN A CONSPICUOUS LOCATION.
- JOINTS IN MULTIPLE LAYERS OF RIGID INSULATION SHALL BE OFFSET.

AIR BARRIERS NOTES

- SEAL, CAULK AND GASKET BUILDING ENVELOPE PER 2015 WSEC, C402.5.
- AIR BARRIER SHALL BE CONTINUOUS ACROSS ALL JOINTS IN ASSEMBLIES. SEAMS AND JOINTS SEALED.
- AIR BARRIER PENETRATIONS SHALL BE SEALED IN ACCORDANCE WITH SECTION C402.4.2.
- ALL DOORS AND OPERABLE WINDOWS TO BE WEATHERSTRIPPED PER 2012 WSEC.
- AIR LEAKAGE TEST: VISUAL INSPECTION IS REQUESTED. ADDITION IS OPEN TO EXISTING BUILDING. SUBMIT A FOLLOWUP REPORT TO THE JURISDICTION INDICATING THAT AIR BARRIER DETAILS HAVE BEEN FOLLOWED.

FENESTRATION NOTES

- FENESTRATION SHALL BE LABELED WITH U-FACTOR, SHGC, VT AND LEAKAGE RATING.

CLOSE-OUT NOTES

- PROJECT CLOSE OUT DOCUMENTATION TO INCLUDE WSEC ENVELOPE COMPLIANCE FORMS COMPLIANCE DOCUMENTATION PER C103.6.3.
- PROVIDE FENESTRATION NRFC RATING CERTIFICATES.

OCCUPANCY

EXISTING R1, B, S1, A3  
ADDITION R1

CONSTRUCTION TYPE

VA, SPRINKLED

ALLOWABLE HEIGHT IN FEET

TABLE 504.3 R S 70' ABOVE GRADE PLANE

EXISTING: 53'-1" @ ADDITION

ALLOWABLE NUMBER OF STORIES

TABLE 504.4 VA S 4 STORIES

EXISTING: 4. ADDITION TO MATCH EXISTING

ALLOWABLE AREA

TABLE 506.2 VA SM 36,000 (4) 144,000 SF

	EXISTING	ADDITION	TOTAL
BASEMENT/GARAGE	15,441 SF	0 SF	15,441 SF
FIRST FLOOR	15,189 SF	168 SF	15,357 SF
SECOND FLOOR	20,296 SF	4,484 SF	24,780 SF
THIRD FLOOR	19,357 SF	4,484 SF	23,841 SF
FOURTH FLOOR	18,892 SF	4,484 SF	23,376 SF
TOTALS	89,175 SF	13,620 SF	102,795 SF

ALLOWABLE AREA INCREASE

NOT TAKEN

AREA SEPARATIONS

TABLE 508.4	SPRINKLED	REQ.	PROVIDED
EXISTING - R1/B		1HR	1HR
ADDITION - R1/R1		0 HR	0 HR

SPECIAL REQUIREMENTS

SECTION 420  
WALLS SEP. SLEEPING UNITS PER 708 FIRE PARTITION 1 HR  
FLOORS SEP. SLEEPING UNITS PER 711 HORIZ. ASSEMBLIES 1 HR

FIRE RESISTANCE REQ. FOR BILDG ELEMENTS

TABLE 601	TYPE VA
PRIMARY STRUCTURAL FRAME	1 HR
BEARING WALLS EXT.	1 HR
BEARING WALLS INT.	1 HR
NON-BEARING WALLS, INT.	1 HR
ROOF	1 HR
FLOOR BETWEEN UNITS	1 HR
FLOOR OVER PARKING	1 HR

FIRE RESISTANCE REQ. BASED ON SEP.

TABLE 602 X>30 (ROW)  
EXISTING NO CHANGE 0

ALLOWABLE AREA OF OPENINGS

T705.8  
10' < 15' SPRINKLED, UNPROTECTED 45%  
NORTH WALL 282 SF/3651 SF = 7.7%

WALL AND CEILING FINISH REQ. BY OCC.

TABLE 803.11	OCC.	SPRINK.	CLASS	FLAME SPREAD	SMOKE DEV.
R1	YES	C	76-200	0-450	

AUTOMATIC SPRINKLER SYSTEMS

EXISTING SPRINKLERS TO BE EXTENDED TO NEW ADDITION  
BIDDER DESIGN, INCLUDES PARKING GARAGE.

OCCUPANT LOAD


OCCUPANCY	B	EXIST. R1	ADDITION R1	S1	M	S2	TOTAL
PARK LVL	-	-	-	1	3	67	71
1ST	184	25	-	2	1	33	245
2ND	59	61	18	2	2	-	142
3RD	-	73	18	2	1	-	94
4TH	-	73	18	2	1	-	94
TOTAL OCCUPANT LOAD:							646

COURTYARD

MIN. WIDTH	INCREASE PER STORY ABOVE 2	REQUIRED	PROVIDED
6' WINDOWS EA. SIDE	2'	8'	22'
MIN. WIDTH	INCREASE PER STORY ABOVE 2	REQUIRED	PROVIDED
3' WINDOW EA. SIDE	2'	5'	9"
MIN. DEPTH			
BOUNDED ON ONE END BY PUBLIC WAY OR YARD. NONE REQ.			




12202 Pacific Ave. Suite C  
Tacoma, Washington 98444  
P: 253.531.4300 F: 253.537.6542  
E: architects@austincina.com

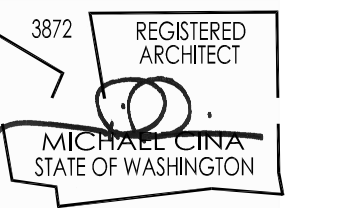


CODE INFORMATION  
Addition to Hampton Inn & Suites  
Hampton Inn & Suites  
1515 S. Meridian, Puyallup, WA

Job #:  
Date: January 6, 2020  
Revs:


A0.2  
PERMIT SET

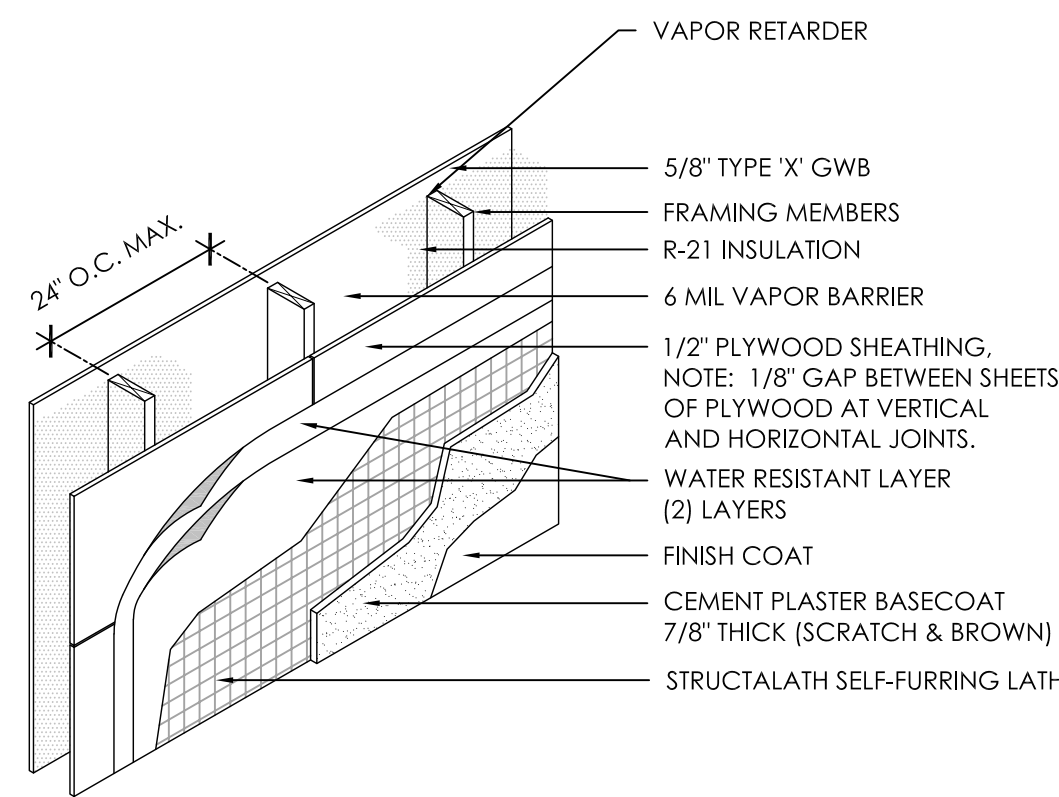


EXTERIOR WALLS  
 FRA-103 1 HOUR ICB0 ES  
 REPORTS 1254 AND 1318

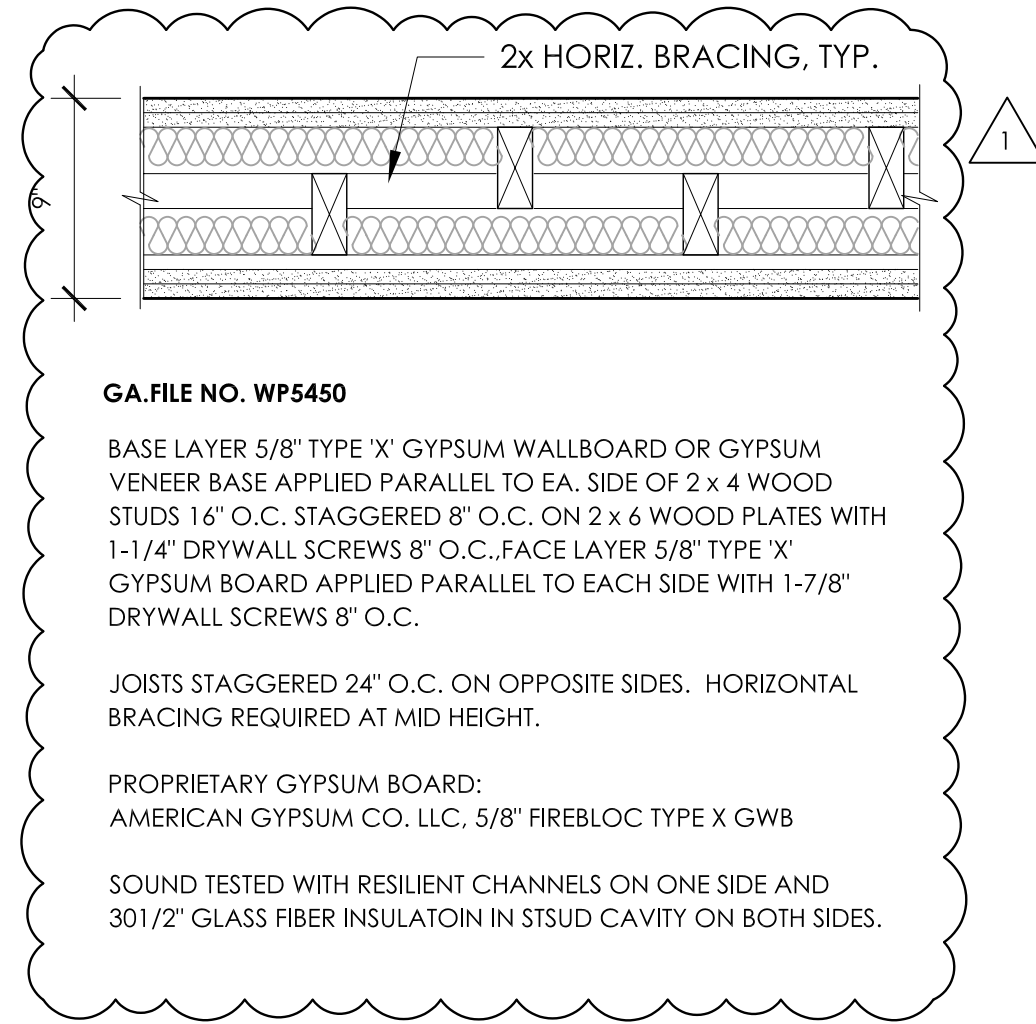


**GA FILE NO. WP5450**  
 BASE LAYER 5/8" TYPE 'X' GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED PARALLEL TO EA. SIDE OF 2 x 4 WOOD STUDS 16" O.C. STAGGERED 8" O.C. ON 2 x 4 WOOD PLATES WITH 1-1/4" DRYWALL SCREWS 8" O.C. FACE LAYER 5/8" TYPE 'X' GYPSUM BOARD APPLIED PARALLEL TO EACH SIDE WITH 1-7/8" DRYWALL SCREWS 8" O.C.  
 JOISTS STAGGERED 24" O.C. ON OPPOSITE SIDES. HORIZONTAL BRACING REQUIRED AT MID HEIGHT.  
 PROPRIETARY GYPSUM BOARD: AMERICAN GYPSUM CO. LLC. 5/8" FIREBLOC TYPE X GWB  
 SOUND TESTED WITH RESILIENT CHANNELS ON ONE SIDE AND 301/2" GLASS FIBER INSULATION IN STUD CAVITY ON BOTH SIDES.

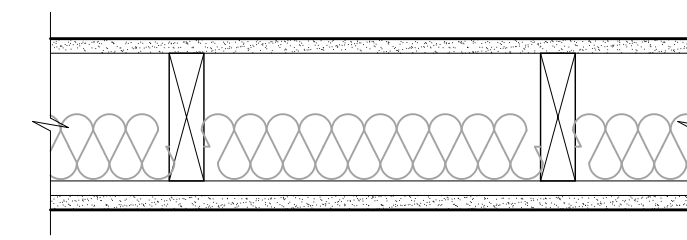

**GA FILE NO. WP3230**  
 ONE LAYER 5/8" TYPE 'X' GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO CHANNELS WITH 1" TYPE 'S' DRYWALL SCREWS 6" O.C. AT HORIZONTAL JOINTS AND 12" O.C. AT INTERMEDIATE CHANNELS. 1 1/2" GLASS FIBER INSULATION .8 PFC STAPLES TO STUDS IN STUD SPACE.  
 OPPOSITE SIDES. ONE LAYER 5/8" TYPE 'X' GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED AT RIGHT ANGLES TO STUD WITH 6d NAILS AT 8" O.C.  
 AT BATHROOMS USE MOISTURE RESISTANT GWB.  
 2 x 6 STUDS PER STRUCTURAL. 3 1/2" FIBER INSULATION PER FILE PROVIDES STC 50-54

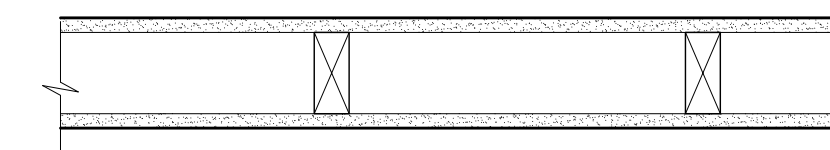


**GA FILE NO. 3644**  
 2 x 4 WOOD STUDS 24" O.C. WITH 1 LAYER 5/8" TYPE 'X' GYPSUM WALLBOARD EACH SIDE.  
 NOTE:  
 ALL WALLS IN BATH SHALL BE MOISTURE RESISTANT GYPSUM BOARD ON BATHROOM SIDE AND HAVE 3-1/2" SOUND BATT BETWEEN BATHROOM AND ADJACENT SPACES.

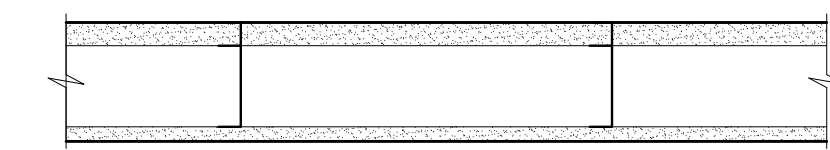

**GA FILE NO. 6905 PROPRIETARY**  
 ONE LAYER 1" x 24" PROPRIETARY TYPE X GYPSUM PANELS INSERTED BETWEEN 2-1/2" FLOOR AND CEILING J RUNNERS WITH TAB-FLANGE SECTION OF 2-1/2" STEEL C-H. CT. OR 1 STUDS @ 16" O.C. BETWEEN PANELS.  
 ONE LAYER 5/8" PROPRIETARY TYPE X GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO STUDS WITH 1" TYPE 'S' DRYWALL SCREWS 12" O.C.  
 NATIONAL GYPSUM 5/8" GOLD BOND BRAND FIRE-SHIELD GWG 1" GOLD BOND BRAND FIRE-SHIELD SHAFTLINER  
 ADD 5/8" MOISTURE RESISTANT GWB @ BATHROOMS




12202 Pacific Ave. Suite C  
 Tacoma, Washington 98444  
 P: 253.531.4300 F: 253.537.6542  
 E: architects@austincina.com

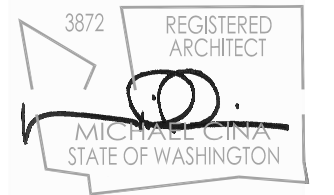


RESPONSE TO PLAN REVIEW  
 COMMENTS 03/03/20

**A TYP. STUCCO WALL ASSEMBLIES**  
 24 x 36 - 1 1/2" = 1'-0"  
 12 x 18 - 3/4" = 1'-0"

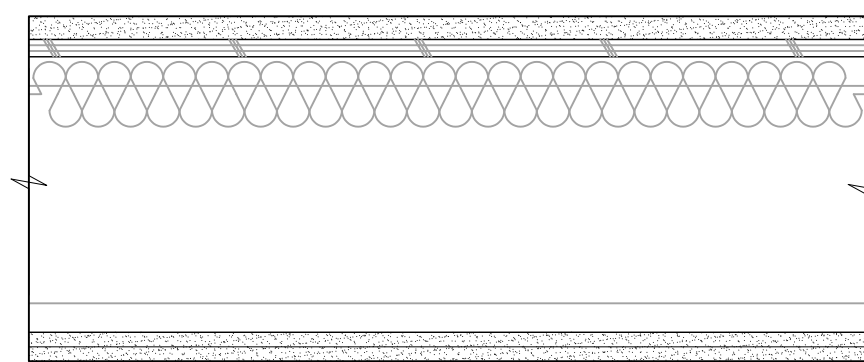


**IBC TABLE 721.1.(3), ITEM NUMBER 21-1.1**  
 FLOOR OR ROOF CONSTRUCTION  
 3/4" STRUCTURAL PANEL WITH EXT. GLUE APPLIED AT RIGHT ANGLES TO TOP OF JOIST WITH 8d NAILS  
 11-7/8" TJI @ 16" O.C.  
 5/8" TYPE X GWB APPLIED AT RIGHT ANGLES TO JOIST WITH 1-1/4" TYPE S OR TYPE X GWB SCREWS 24" O.C.  
 SECOND LAYER OF TYPE X GWB APPLIED AT RIGHT ANGLES TO JOIST WITH 1-7/8" TYPE S OR TYPE 2 DRYWALL SCREWS 12" O.C. AT JOINTS AND INTERMEDIATE JOIST.  
 FACE LAYER TYPE G DRYWALL SCREWS PLACED 2" BACK ON EITHER SIDE OF FACE LAYER END JOINTS. 12" O.C.  
 ADD. 1" LIGHT WT. CONCRETE TOPPING ON STRUCTURAL PANEL

**B 2 HR SOUND WALL @ GUEST ROOMS**  
 24 x 36 - 1 1/2" = 1'-0"  
 12 x 18 - 3/4" = 1'-0"

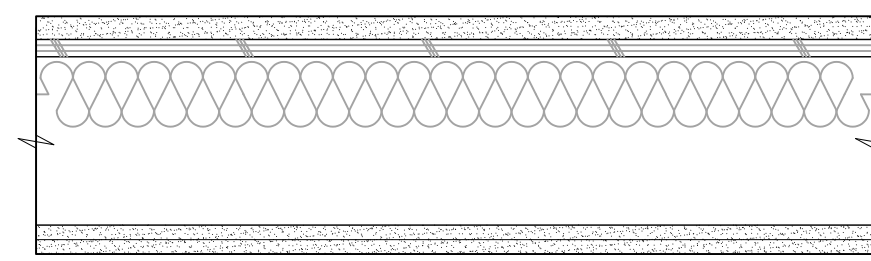


**IBC TABLE 721.1.(3), ITEM NUMBER 21-1.1**  
 FLOOR OR ROOF CONSTRUCTION  
 3/4" STRUCTURAL PANEL WITH EXT. GLUE APPLIED AT RIGHT ANGLES TO TOP OF JOIST WITH 8d NAILS  
 2x8 JOISTS @ 16" O.C.  
 5/8" TYPE X GWB APPLIED AT RIGHT ANGLES TO JOIST WITH 1-1/4" TYPE S OR TYPE W DRYWALL SCREWS 24" O.C.  
 SECOND LAYER OF TYPE X GWB APPLIED AT RIGHT ANGLES TO JOIST WITH 1-7/8" TYPE S OR TYPE 2 DRYWALL SCREWS 12" O.C. AT JOINTS AND INTERMEDIATE JOIST.  
 FACE LAYER TYPE G DRYWALL SCREWS PLACED 2" BACK ON EITHER SIDE OF FACE LAYER END JOINTS. 12" O.C.  
 ADD. 1 1/2" LIGHT WT. CONCRETE TOPPING ON STRUCTURAL PANEL

**C 1 HR TYP. CORRIDOR WALLS**  
 24 x 36 - 1 1/2" = 1'-0"  
 12 x 18 - 3/4" = 1'-0"

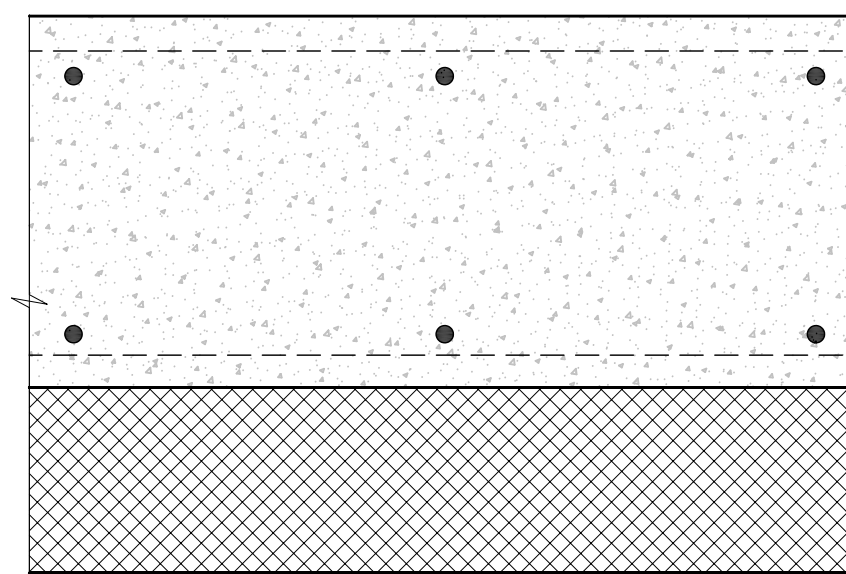


**IBC TABLE 721.1.(3), ITEM NUMBER 1-1.1**  
 16" CONCRETE SLAB  
 R38 RIGID INSULATION MECH. FASTENED TO CONC. DECK  
 ALL JOINTS TAPED WITH MATCHING TAPE BY SAME MFR.

**D TYP. 1 HR. WALL**  
 24 x 36 - 1 1/2" = 1'-0"  
 12 x 18 - 3/4" = 1'-0"

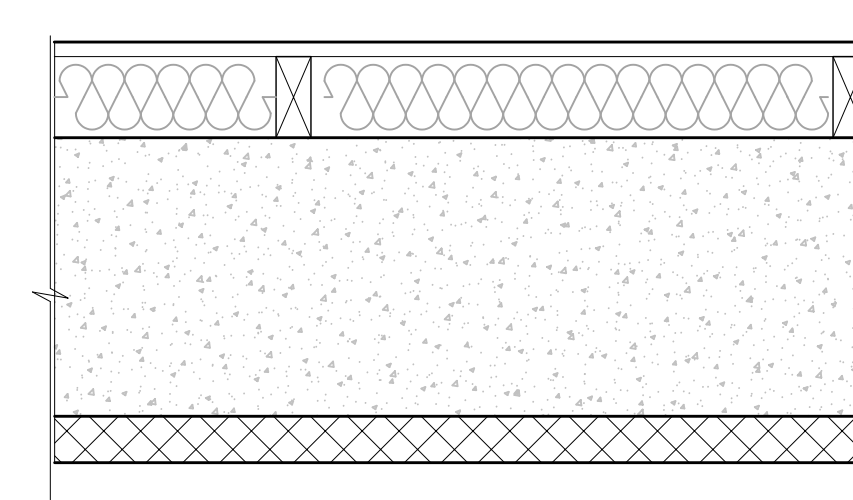

5/8" TYPE X GWB  
 R-13 BATT INSULATION  
 TRT 2x4 @ 24" O.C.  
 8" OR 12" CONCRETE WALL  
 2" EIFS SYSTEM

**E TYP. 1 HR. SHAFT WALL**  
 24 x 36 - 1 1/2" = 1'-0"  
 12 x 18 - 3/4" = 1'-0"

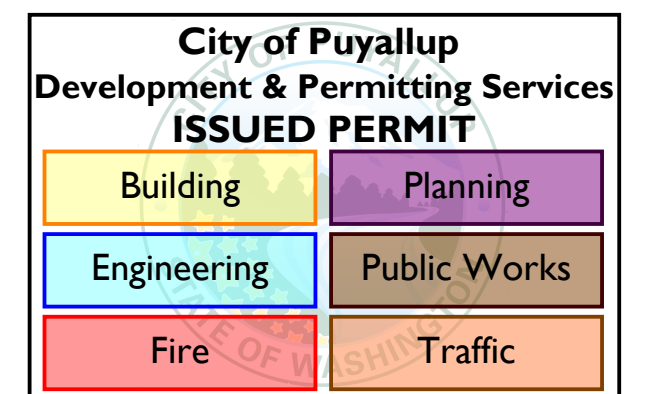

**F 1-HOUR FLOOR-CLG**  
 24 x 36 - 1 1/2" = 1'-0"  
 12 x 18 - 3/4" = 1'-0"

**G 1 HOUR FLOOR-CLG @ CORRIDOR**  
 24 x 36 - 1 1/2" = 1'-0"  
 12 x 18 - 3/4" = 1'-0"


**H 1-HOUR FLOOR-CLG SEPARATION**  
 24 x 36 - 1 1/2" = 1'-0"  
 12 x 18 - 3/4" = 1'-0"

**I CONCRETE STAIRWELL WALL**  
 24 x 36 - 1 1/2" = 1'-0"  
 12 x 18 - 3/4" = 1'-0"

WALL AND FLOOR-CLG TYPES  
 Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA


Job #:  
 Date: January 6, 2020  
 Revs: March 10, 2020

**1 or 2 Hour Rated Firestop For Metallic Piping Systems Through Wood Floor-Ceiling Assemblies Using SpecSeal Series 100 Sealant**

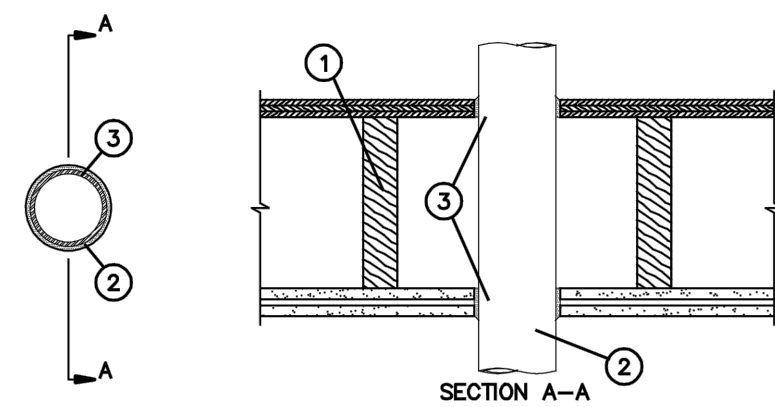


- One or two hour rated wood floor-ceiling assembly consisting of:
  - Gypsum board membrane with fasteners and/or furring strips as required by rated firestop design.
  - Joists, steel or combination lumber and steel joists, trusses or structural wood members with bridging as per the individual U.L. Floor-Ceiling Designs.
  - Plywood sub-floor with finish floor as req'd.
- Max 4" Steel or Iron pipe, Copper pipe or tubing, Steel conduit or EMT. Nominal 1/4" annulus required.
- SpecSeal Series 100 Sealant installed to 1/2" depth, flush with top surface of floor and bottom surface of ceiling. Additional fill material installed such that a min. 1/4" crown is formed around through penetrant.

**1 Hour Rated Firestop For Non-Metallic Piping Systems Through Wood Floors Using SpecSeal SSWRD Wrap Strip & SpecSeal Series 100 Sealant**

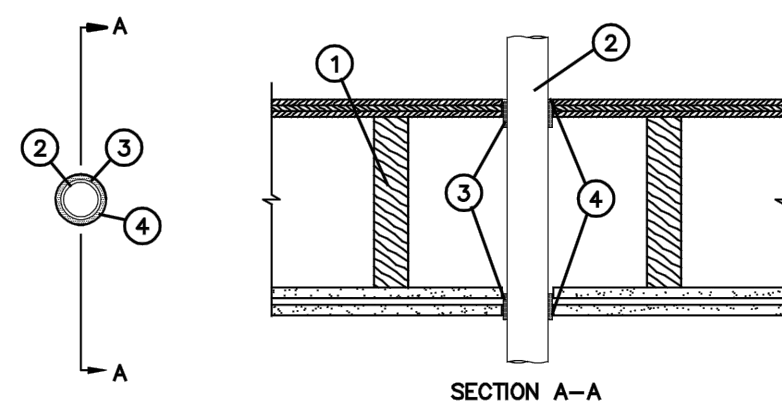


- One or two hour rated wood floor-ceiling assembly consisting of:
  - Gypsum board membrane with fasteners and/or furring strips as required by rated firestop design.
  - Joists, steel or combination lumber and steel joists, trusses or structural wood members with bridging as per the individual U.L. Floor-Ceiling Designs.
  - Plywood sub-floor with finish floor as req'd.
- Max 2" trade size nonmetallic pipe (vented or closed) or conduit:
  - PVC pipe or conduit.
  - PVC Cellular Core.
  - CPVC.
  - EMT.
  - Nominal 1/4" annulus required.
- SpecSeal SSWRD Wrap Strip. One layer wrapped around each pipe at its egress from both sides of the floor-ceiling assembly. Fully encircle each strip with one layer of aluminum foil tape (SSWFT). Bottom edge of wrap strip shall extend 1/4" below ceiling and 5/8" below floor.
- SpecSeal Series 100 Sealant forced into annulus to max extent.

**1 Hour Rated Firestop For Non-Metallic Piping Systems Through Wood Floor-Ceiling Assemblies Using SpecSeal Series 100 Sealant**

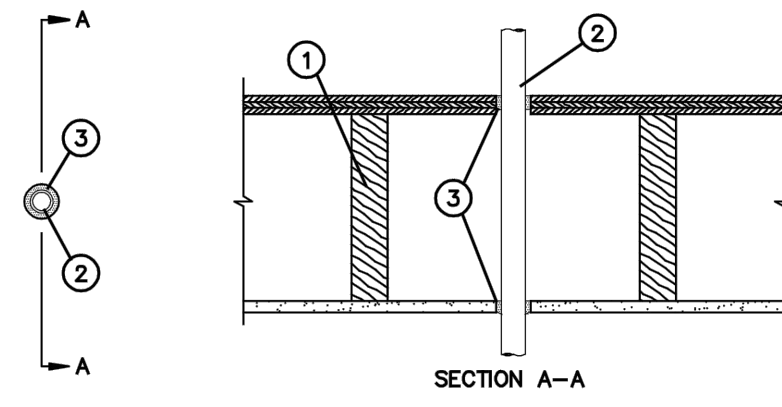


- One hour rated wood floor-ceiling assembly consisting of:
  - Gypsum board membrane with fasteners and/or furring strips as required by rated firestop design.
  - Joists, steel or combination lumber and steel joists, trusses or structural wood members with bridging as per the individual U.L. Floor-Ceiling Designs.
  - Plywood sub-floor with finish floor as req'd.
- Nonmetallic pipes, conduits or tubing (closed). Nominal 5/8" annular space required. See Figure 3 for more information.
- SpecSeal Series 100 Sealant. Min 3/4" thickness of fill material applied within annulus, flush with bottom surface of ceiling. Additional sealant installed such that a min 1/8" crown is formed around through penetrant.

**1 Hour Rated Firestop For Chase Enclosed Nonmetallic Piping Through Wood Floors Using SpecSeal Series 100 Sealant**

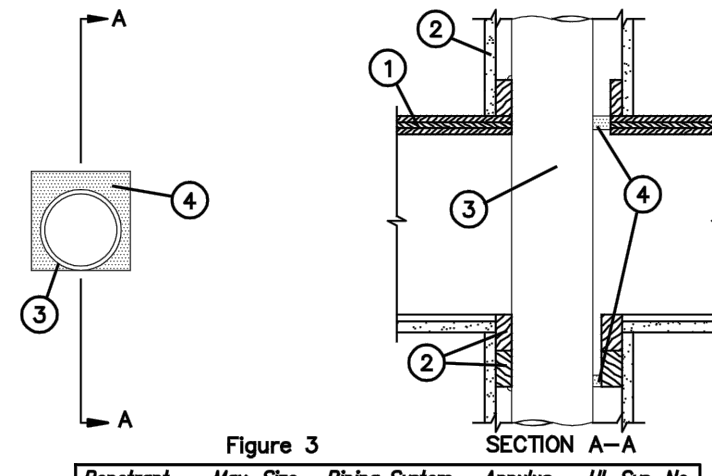


- One hour rated wood floor-ceiling assembly consisting of:
  - Gypsum board membrane with fasteners and/or furring strips as required by rated firestop design.
  - Joists, steel or combination lumber and steel joists, trusses or structural wood members with bridging as per the individual U.L. Floor-Ceiling Designs.
  - Plywood sub-floor with finish floor as req'd.
- Nonmetallic pipe, conduit or tubing. See Figure 3 for more information.
- SpecSeal Series 100 Sealant installed to a 3/4" thickness within annulus, flush with top surface of floor. Minimum 5/8" thickness of fill material applied within annulus, flush with bottom surface of lower plate of chase wall assembly.

**1 Hour Rated Firestop For Plastic (Non-Metallic) Piping Systems in Wood Floors Using SpecSeal Firestop Collars & SpecSeal Series 100 Sealant**

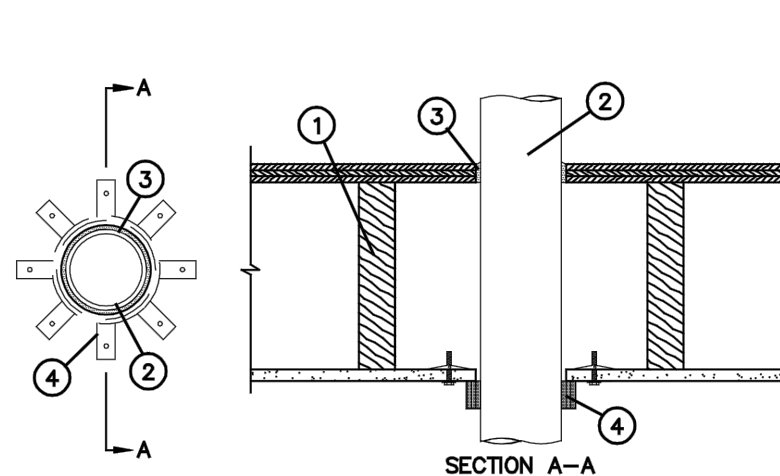

- One hour rated wood floor-ceiling assembly consisting of:
  - Gypsum board membrane with fasteners and/or furring strips as required by rated firestop design.
  - Joists, steel or combination lumber and steel joists, trusses or structural wood members with bridging as per the individual U.L. Floor-Ceiling Designs.
  - Plywood sub-floor with finish floor as req'd.
- Max 4" nonmetallic pipe (vented or closed) or conduit:
  - PVC (cellular or solid core).
  - ABS (cellular or solid core).
  - Nominal 1/4" annulus required.
- SpecSeal Series 100 Sealant installed within top annulus to a 3/4" depth with 1/8" crown.
- SpecSeal Firestop Collar. Place appropriate number of layers around pipe, enclose with 30 gauge steel restraining collar (SSWRC2) and secured with three #8 wood screws and 1/4" x 1" fender washers. See Figure 2 for number of mounting tabs required to be fastened. Annulus shall range from point contact to 1/4" maximum.

**1 Hour Rated Firestop For Plastic Plumbing Systems in Wood Floors Using SpecSeal Products**

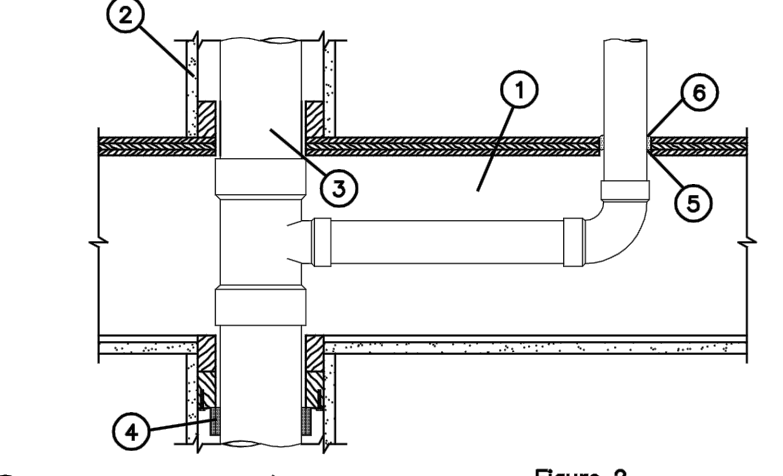

- One hour rated wood floor-ceiling assembly consisting of:
  - Gypsum board membrane with fasteners and/or furring strips as required by rated firestop design.
  - Joists, steel or combination lumber and steel joists, trusses or structural wood members with bridging as per the individual U.L. Floor-Ceiling Designs.
  - Plywood sub-floor with finish floor as req'd.
- One hour rated chase wall assembly:
  - Vented (DWV) PVC or ABS solid or cellular core fittings & pipes. Max sanitary tee shall be 4" x 4" x 4".
- SpecSeal SSWRD Wrap Strip Collar. Place appropriate number of layers around pipe with an additional 1/4" bead applied to periphery of wrap strip at floor interface. Caulk is not req'd around collar but is recommended as a smoke seal.
- SpecSeal SSWRD Wrap Strip. Place one layer around 2" drain. Fully enclose with aluminum foil tape (SSWFT) and center within floor. Annulus after installation of wrap strip shall range from point contact to 1/4" maximum.
- SpecSeal Series 100 Sealant. Fill annulus around wrap strip to a minimum 3/4" depth with an additional 1/4" bead applied to periphery of wrap strip at floor interface. Caulk is not req'd around collar but is recommended as a smoke seal.

**1 SYSTEM FC-2010**  
N.T.S.

**1 Hour Rated Firestop For Plastic (Non-Metallic) Piping Systems in Wood Floors Using SpecSeal Firestop Collars & SpecSeal Series 100 Sealant**

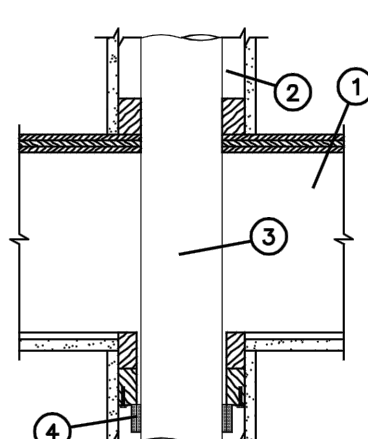



Figure 3

Up to Trade Size	2"	3"	4"
Layers of Wrap Strip Required	1	2	2
Minimum Restraining Collar Length	11"	15.5"	19.0"
Fastener Screw Length	1/4"	1/2"	1/2"
Minimum No. Fasteners	2	3	4

- One hour rated wood floor-ceiling assembly consisting of:
  - Gypsum board membrane with fasteners and/or furring strips as required by rated firestop design.
  - Joists, steel or combination lumber and steel joists, trusses or structural wood members with bridging as per the individual U.L. Floor-Ceiling Designs.
  - Plywood sub-floor with finish floor as req'd.
- One hour rated chase wall assembly. Note: Studs must be wide enough to accommodate pipe and collar.
- PVC, CPVC or ABS pipe (vented or closed) or RNC.
  - PVC & ABS may be cellular or solid-core.
  - Max pipe shall be 4" trade size.
  - Nominal 1/4" annulus required.
- SpecSeal SSWRD Wrap Strip Collar. Place appropriate number of layers around pipe, enclose with 30 gauge steel restraining collar (SSWRC2) and secure with three #8 wood screws and 1/4" x 1" fender washers. See Figure 2 for number of mounting tabs required to be fastened.

**2 SYSTEM FC-2019**  
N.T.S.


**1 or 2 Hour Rated Firestop For Metallic Piping Through Gypsum Board Walls Using SpecSeal Putty or SpecSeal Series 100 Sealant**

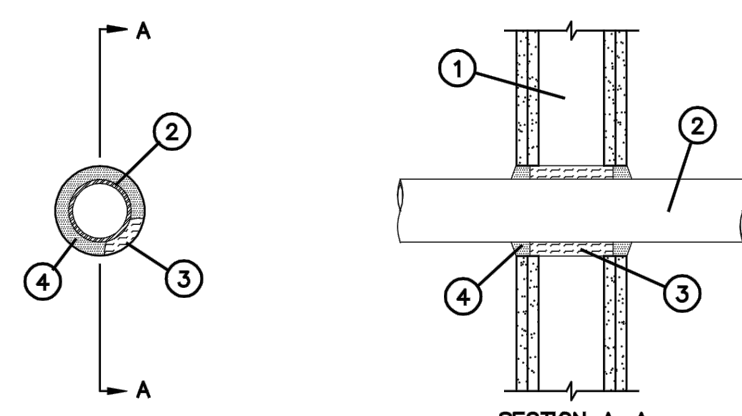

- Rated gypsum wallboard assembly.
  - Max 4" Steel pipe or conduit, Copper pipe or tubing or EMT. Nominal 3/4" annulus required.
  - Fiberglass insulation material wrapped around the through penetrant, secured with a steel tie wire and centered within the opening. Recess packing material to accommodate fill material.
  - SpecSeal Series 100 Sealant or SpecSeal Putty installed to required depth as tabulated below:
- | F Rating | Fill Material        |
|----------|----------------------|
| 1HR      | 5/8" with 3/8" crown |
| 2HR      | 3/4" with 1/4" crown |

**3 SYSTEM FC-2032**  
N.T.S.


**1 or 2 Hour Rated Firestop For Metallic Piping Through Gypsum Board Walls Using SpecSeal Series 100 Sealant**

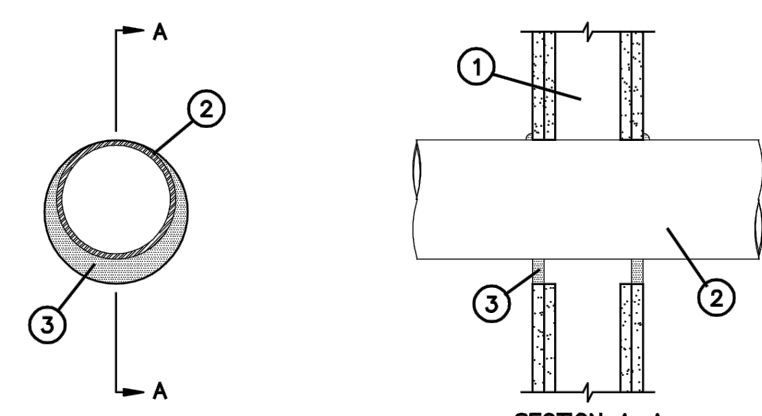

- Rated gypsum wallboard assembly.
- Max 24" Steel or Iron pipe, 6" Copper pipe or tube, 6" Steel conduit, 4" EMT or 1" flexible metallic conduit. The annular space within the firestop system shall range from point contact to 1-3/4" max.
- SpecSeal Series 100 Sealant installed within annulus to 5/8" depth. At point contact, install a 3/8" bead at penetrant/gypsum wallboard interface.

**4 SYSTEM FC-2032 & 2102**  
N.T.S.


**1 or 2 Hour Rated Firestop For Non-Metallic Piping Through Gypsum Board Walls Using SpecSeal Firestop Collars**

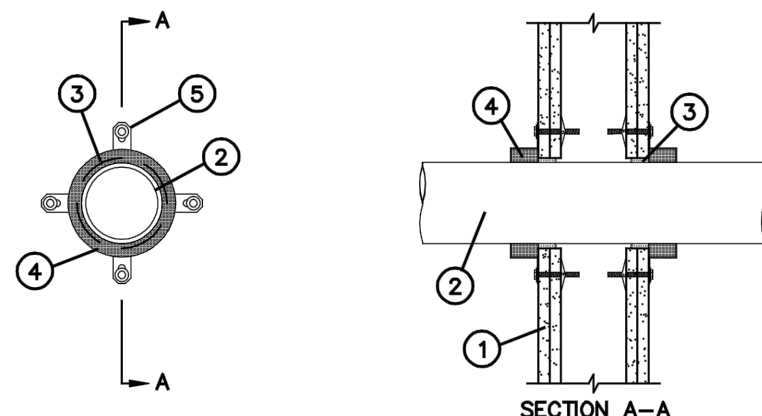

- Rated gypsum wallboard assembly.
- Nonmetallic pipe, vented or closed.
  - PVC pipe or conduit.
  - PVC cellular core.
  - CPVC.
  - FR Polypropylene.
  - ABS.
  - ABS cellular core.
  - Nominal 1/4" annular space required.
- SpecSeal Series 100 Sealant, nominal 3/8" bead installed flush with both sides of wall.
- SpecSeal Firestop Collar. See Figure 3 for more information.
- Steel fender washers with steel molly-type expanding anchors or toggle bolts.

**5 SYSTEM FC-2033**  
N.T.S.


**1 or 2 Hour Rated Firestop For Nonmetallic Piping Through Gypsum Board Walls Using SpecSeal Red Strip & SpecSeal Series SSS Sealant**

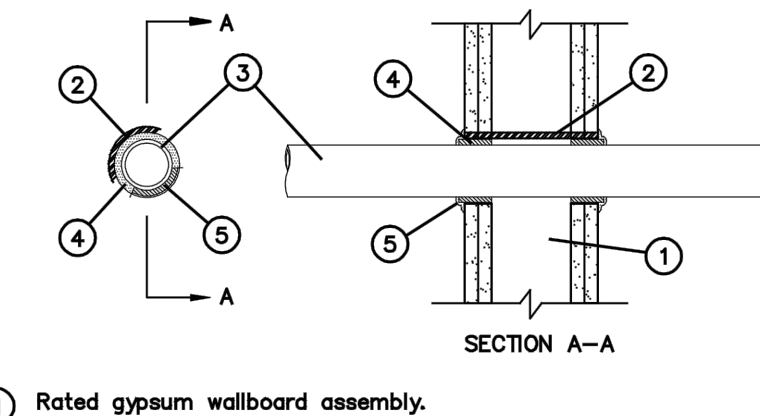

- Rated gypsum wallboard assembly.
- Optional, nom 3" diam (or smaller) steel sleeve friction-fit into wall, flush with both wall surfaces.
- Max 2" trade size nonmetallic pipe (vented or closed) or conduit:
  - PVC (solid or cellular core).
  - ABS (solid or cellular core).
  - CPVC.
  - PVC RNC.
  - FRPP.
  - Nominal 5/16" annular space required.
- SpecSeal Series 100 Sealant, nominal 3/8" bead installed flush with both sides of wall. Secure wrap strip with two layers of aluminum foil tape (SSWFT) and slide strip into opening such that min 1/4" projects from each face of wall.
- SpecSeal Series SSS Sealant. Min 1/4" thick bead applied at wrap strip/wallboard interface on both sides of wall.

**6 SYSTEM FC-2034**  
N.T.S.

**1 or 2 Hour Rated Firestop For Non-Metallic Piping Through Gypsum Board Walls Using SpecSeal Series SSS Sealant**

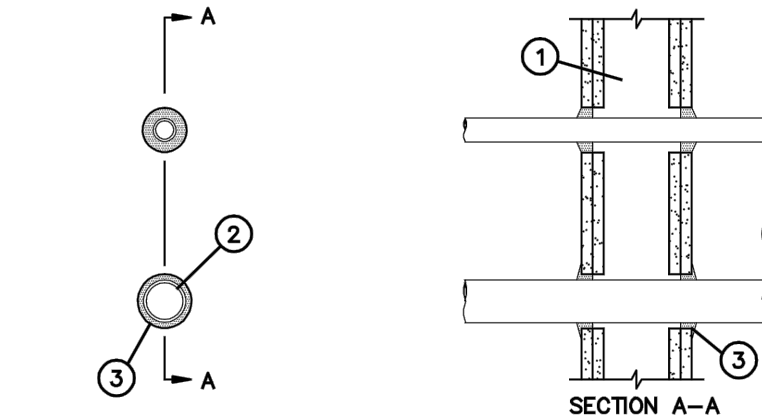

- Rated gypsum wallboard assembly.
- Nonmetallic pipe, conduit, raceway or tubing. See Figure 3 for more information.
- SpecSeal Series SSS Sealant installed to 5/8" depth, flush with both surfaces of the wall. Additional fill material installed such that a min 1/4" crown is formed around through penetrant.

Figure 3

Penetrant	Trade Size	Piping Conditions	Annulus	U.L. Sys. No.
PVC or CPVC	2"	Closed	5/16"	W-L-2093
RNC, ENMT	2"	N/A	5/16"	W-L-2093
Interduct (PVC)	2"	N/A	5/16"	W-L-2093
Interduct (FRPP)	2"	N/A	5/16"	W-L-2093
PE, PEX	1.25"	N/A	5/16"	W-L-2100
ABS, coABS, PVC, coPVC, or CPVC	1.5"	Vented	3/8"	W-L-2100

**7 SYSTEM FC-2035**  
N.T.S.

**1 or 2 Hour Rated Firestop For Insulated Metallic Piping Through Gypsum Board Walls Using SpecSeal Series 100 Sealant**

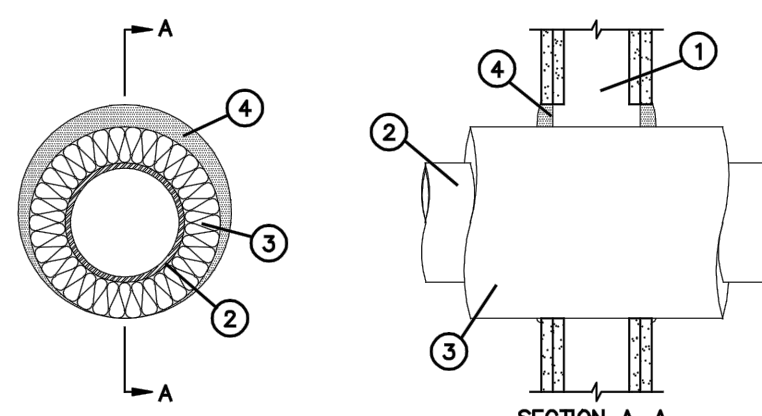


Figure 3

Penetrant	Max Size	Insulation Type	Insulation Thickness	Annulus	U.L. Sys. No.
Steel or Iron Pipe	12"	FC	2"	0" to 1-1/4"	W-L-5014
Copper Pipe or Tube	4"	FC	2"	0" to 1-1/4"	W-L-5014
Steel, Iron or Copper Pipe or Tube	4"	AB/PVC	3/4"	0" to 7/8"	W-L-5054

- Rated gypsum wallboard assembly.
  - Insulated metallic pipe or tube. See Figure 3 for more information.
  - SpecSeal Series SSS Sealant installed to 5/8" depth, flush with both surfaces of the wall. Additional fill material installed such that a min 1/4" crown is formed around through penetrant. AT point contact, install a 1/4" thick bead at the pipe covering/wallboard interface.
- Note: U.L. System W1 5014 allows for continuous point contact (360).

**8 SYSTEM WL-1029**  
N.T.S.

**1 or 2 Hour Rated Firestop For Insulated Metallic Piping Using SpecSeal Series 100 Sealant & SpecSeal SSWRD Wrap Strip**

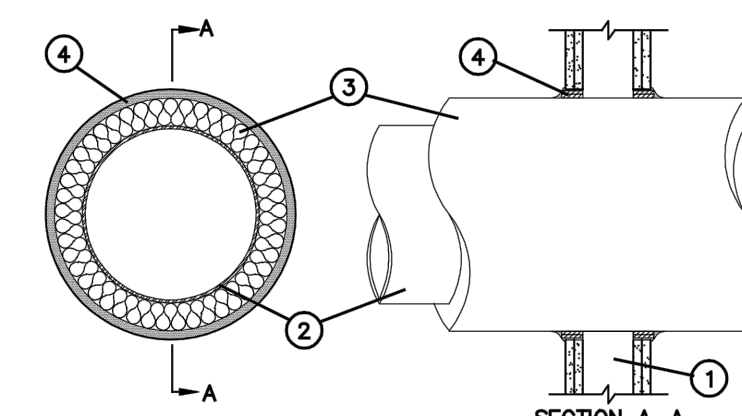


Figure 3

Insulation Thickness	2"	3"
Layers of Wrap Strip	1	2
Minimum Annulus	1/4"	1/2"
Maximum Annulus	1/2"	3/4"

- Rated gypsum wallboard assembly.
- Max 12" Steel or Iron pipe insulated with up to 3" of fiberglass or mineral wool pipe insulation. See Figure 3 for more information.
- SpecSeal SSWRD Wrap Strip. See Figure 3 for required number of wrap strips. Wrap each layer individually around pipe and secure with steel tie wire. Center wrap strips within the opening.
- SpecSeal Series 100 Sealant. Install a 1/4" bead of sealant at both the wrap strip/wall and wrap strip/pipe covering interface.

**13 SYSTEM WL-5014 & 5054**  
N.T.S.


**14 SYSTEM WL-5033**  
N.T.S.

City of Puyallup  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic



12202 Pacific Ave. Suite C  
Tacoma, Washington 98444  
P: 253.531.4300 F: 253.537.6542  
E: architects@austincina.com

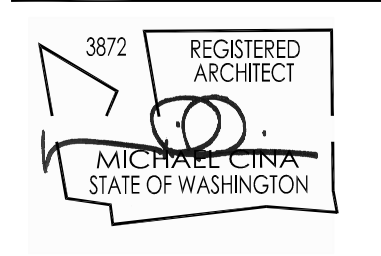

**REQUIRED PARKING**

EXISTING GUEST ROOMS:	122	
DEMOLISHED GUEST ROOMS:	-4	
NEW GUEST ROOMS:	30	
TOTAL GUEST ROOMS:	148	= 148 SPACES
MEETING SPACE:	546 SF/90	= 6 SPACES
EMPLOYEES:	1 SPACE/2 EMP.	= 3 SPACES
TOTAL:		157 SPACES

**PROVIDED PARKING**  
30 GUEST ROOMS ADDED (26 NET, 4 GUEST ROOMS DEMOLISHED)  
26 NEW PARKING SPACES ADDED


**PROVIDED PARKING**

	REGULAR	COMPACT	HC	TOTAL
EXISTING GARAGE:	21	16	2	
EXISTING PARKING:	55	34	3	
NEW PARKING:	3	22	1	
	79	72	6	157

ALLOWABLE COMPACT PARKING: 30-50% ACTUAL: 46%

**City of Puyallup**  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

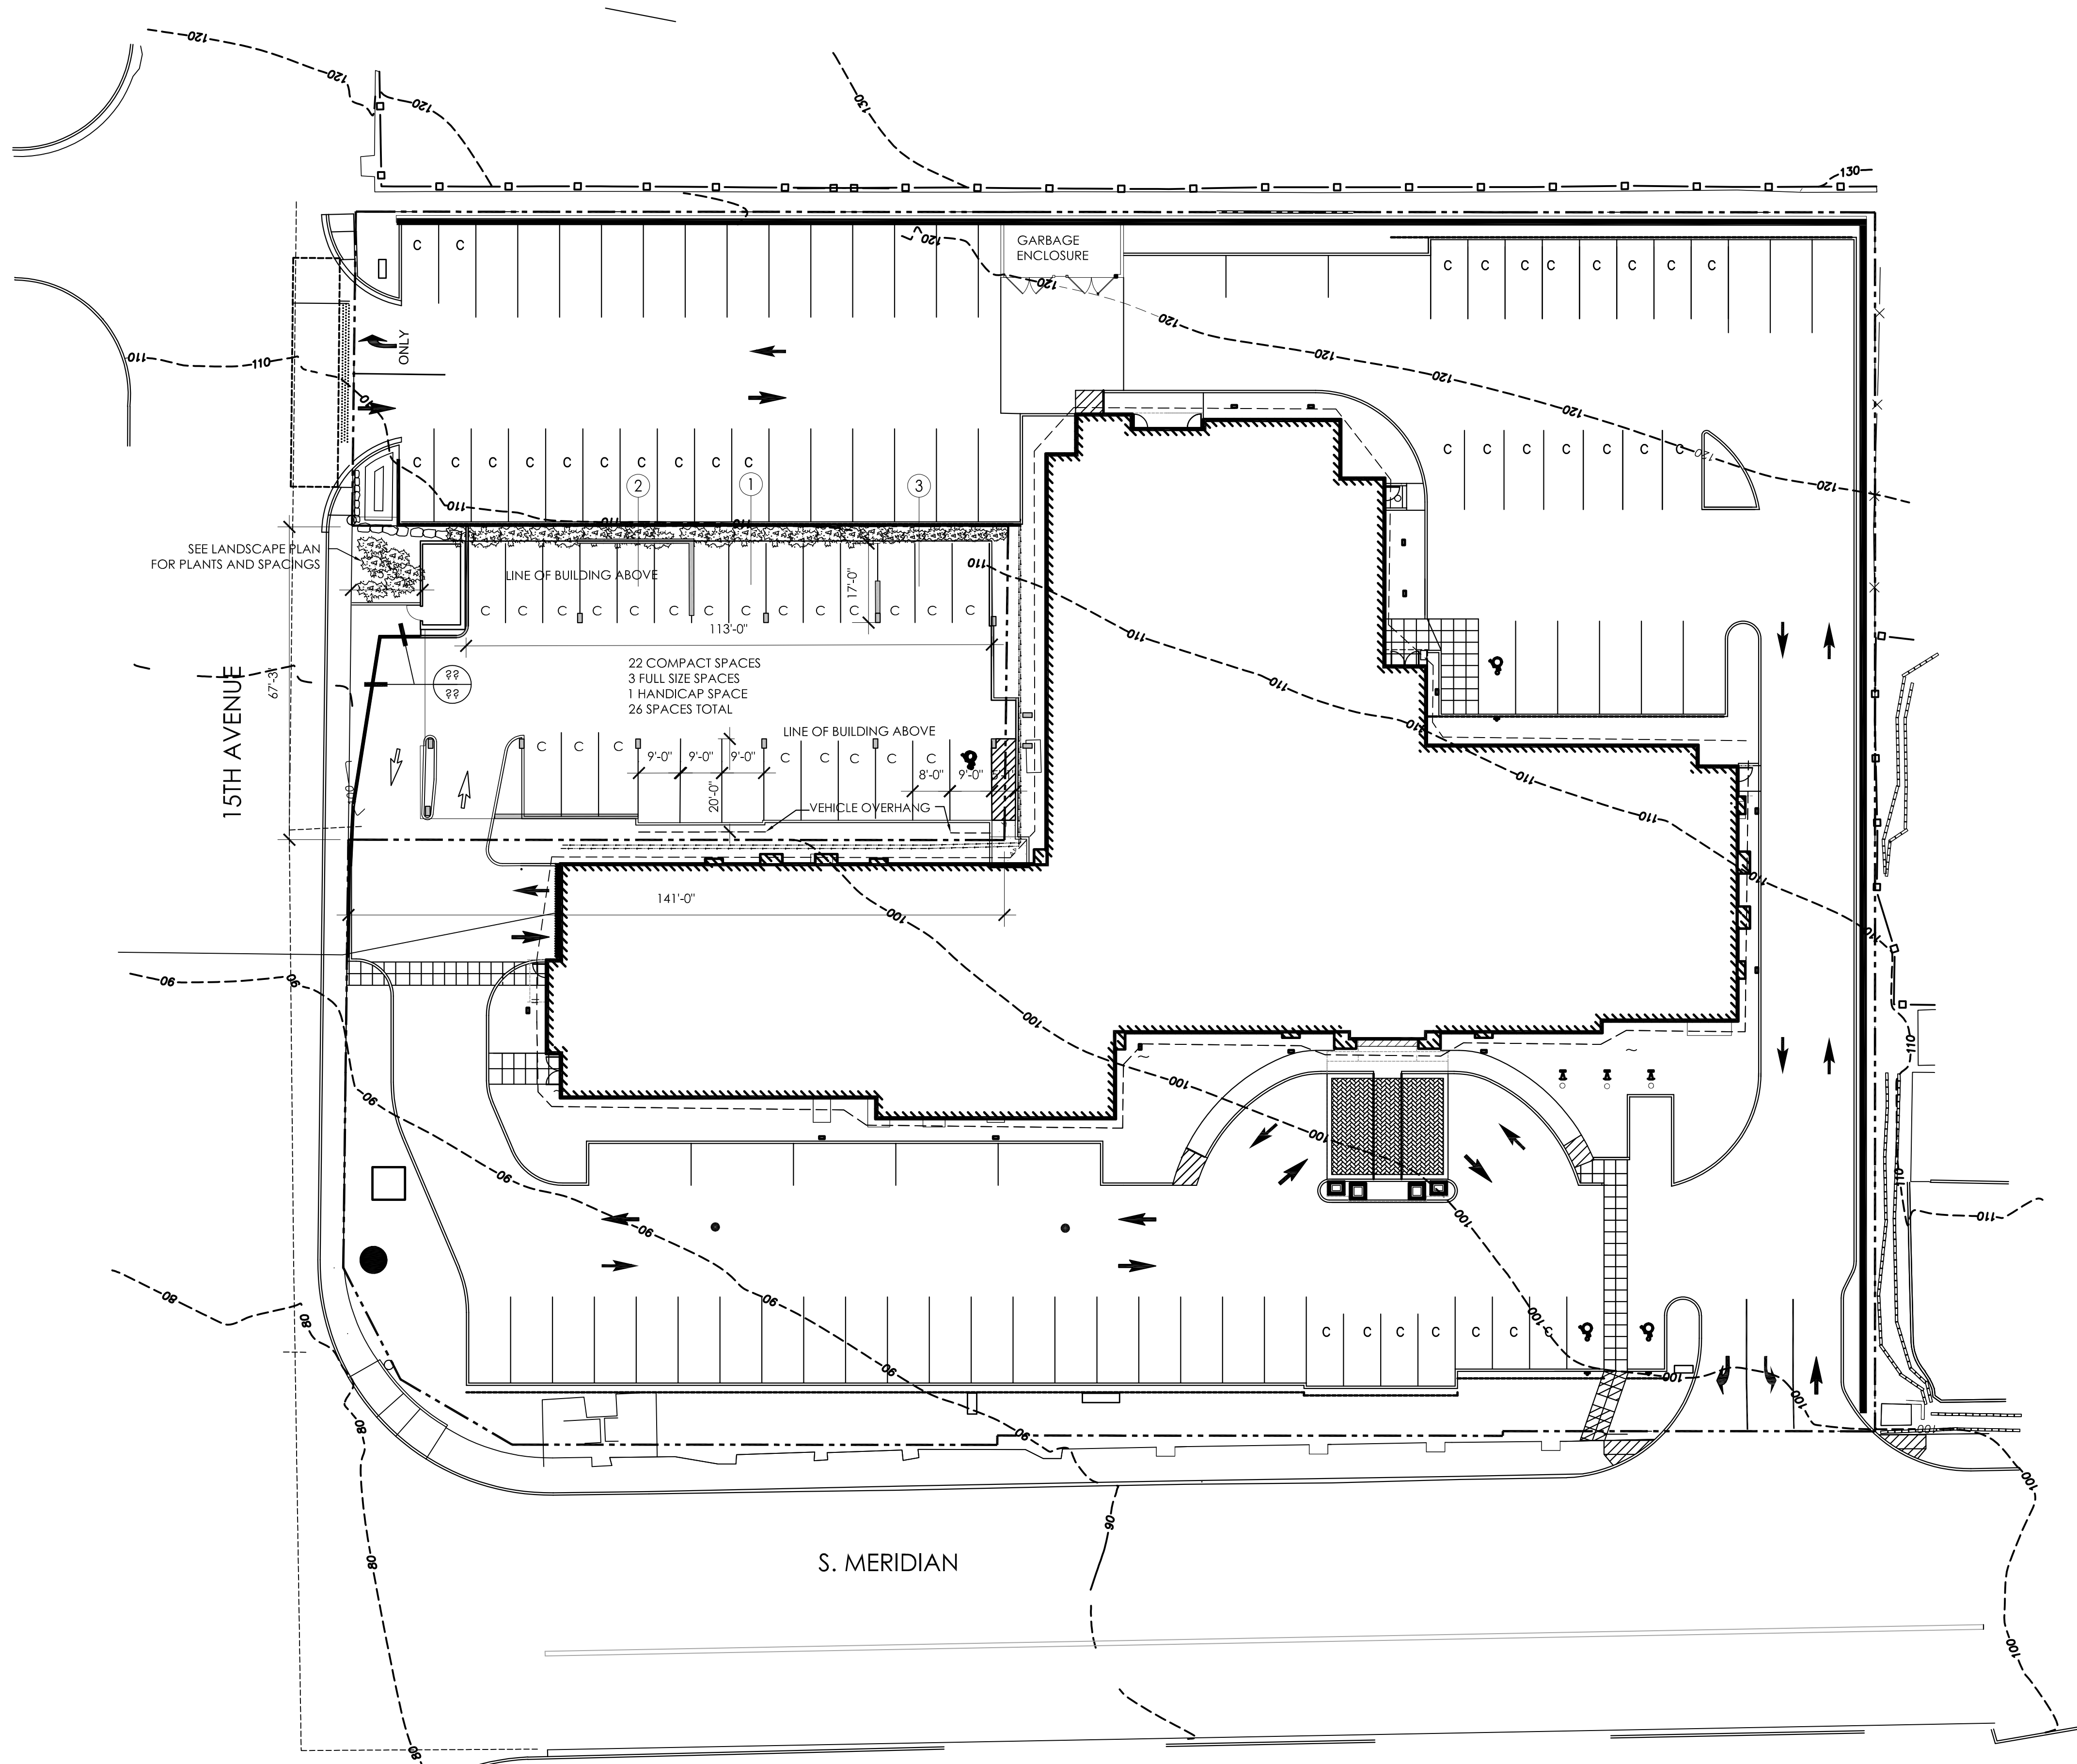


**SITE PLAN**  
FULL SCALE 1:20  
HALF SCALE 1:40


NOTE:  
EXISTING SITE PLAN TAKEN FROM  
ORIGINAL CONSTRUCTION DOCUMENTS.

**OVERALL SITE PLAN**  
Addition to Hampton Inn & Suites  
Hampton Inn & Suites  
1515 S. Meridian, Puyallup, WA

Job #:  
Date: January 6, 2020  
Revs:

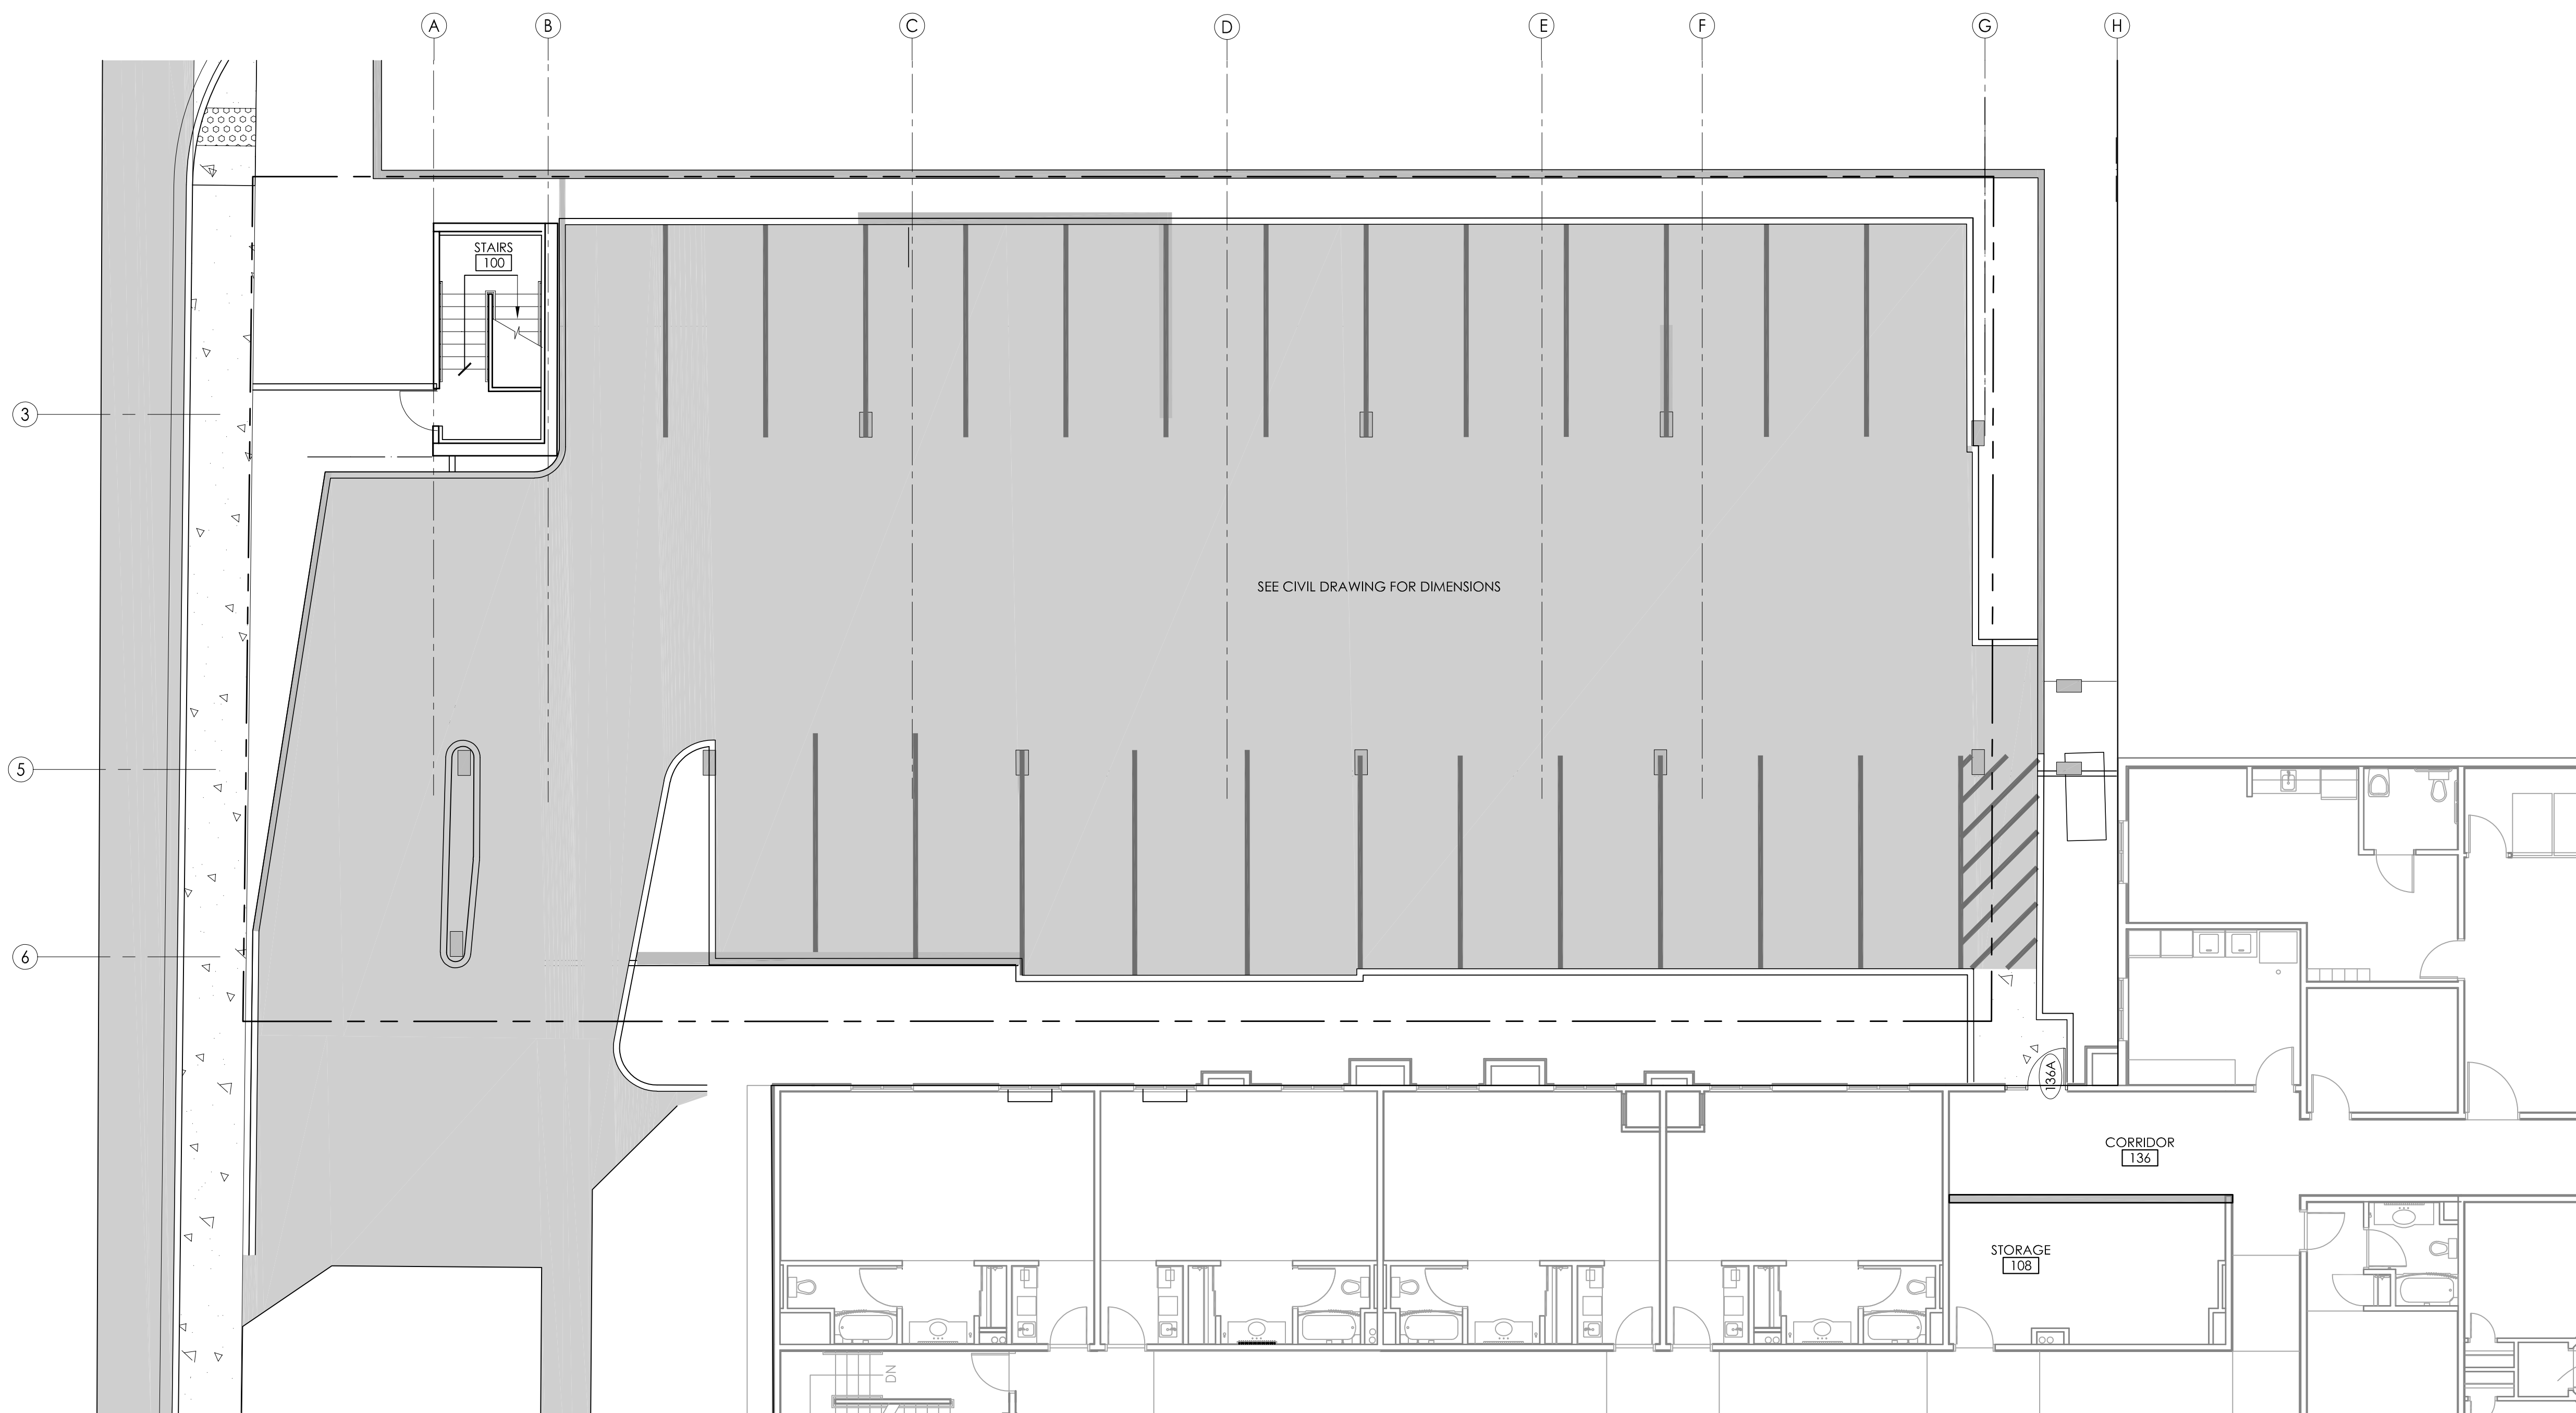

**1ST FLOOR PLAN**  
 24 x 36 - 1/8" = 1'-0"  
 12 x 18 - 1/16" = 1'-0"

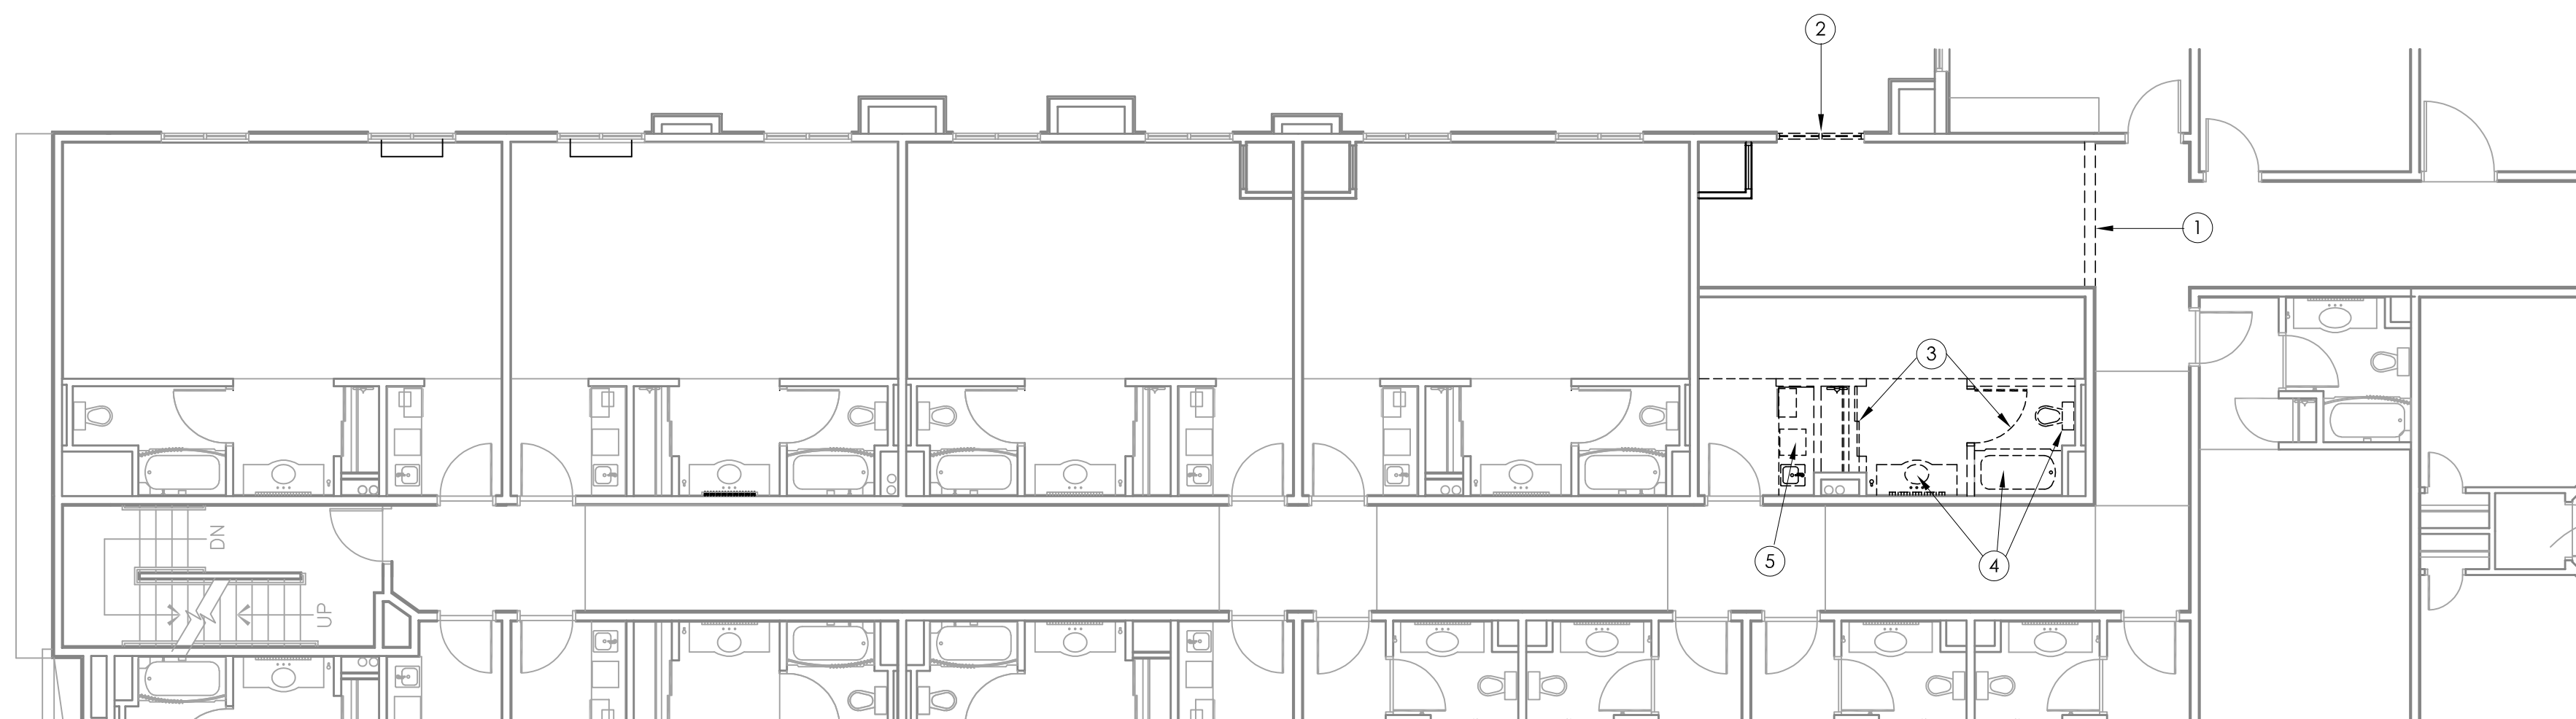

**SELECTIVE DEMOLITION - 1ST FLOOR**  
 24 x 36 - 1/8" = 1'-0"  
 12 x 18 - 1/16" = 1'-0"

**GENERAL NOTES**

- SEE SHEETS A2.10 THRU 2.13 FOR ENLARGED PLANS AND INTERIOR ELEVATIONS.

**LEGEND**

- WALL TYPE, SEE SHEET A0.3
- (E) EXISTING

**ROOM DESIGNATIONS**

- DQ DOUBLE QUEEN
- ACC.DQ ACCESSIBLE DOUBLE QUEEN
- K KING
- (E) EXISTING

**City of Puyallup**  
 Development & Permitting Services  
**ISSUED PERMIT**


Building	Planning
Engineering	Public Works
Fire	Traffic

**KEY NOTES**

- REMOVE (E) WALL, TYP., @ DASHED WALLS
- REMOVE (E) WINDOW
- REMOVE (E) DOORS
- REMOVE (E) LAVATORY, WATER CLOSET, AND BATHTUB/SHOWER.
- REMOVE (E) KITCHENETTE




12202 Pacific Ave. Suite C  
 Tacoma, Washington 98444  
 P: 253.531.4300 F: 253.537.6542  
 E: architects@austincina.com

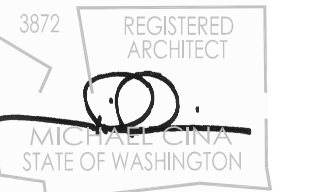


**1ST FLOOR PLAN**  
**SELECTIVE DEMOLITION - FIRST FLOOR**  
 Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA

Job #:  
 Date: January 6, 2020  
 Revs:

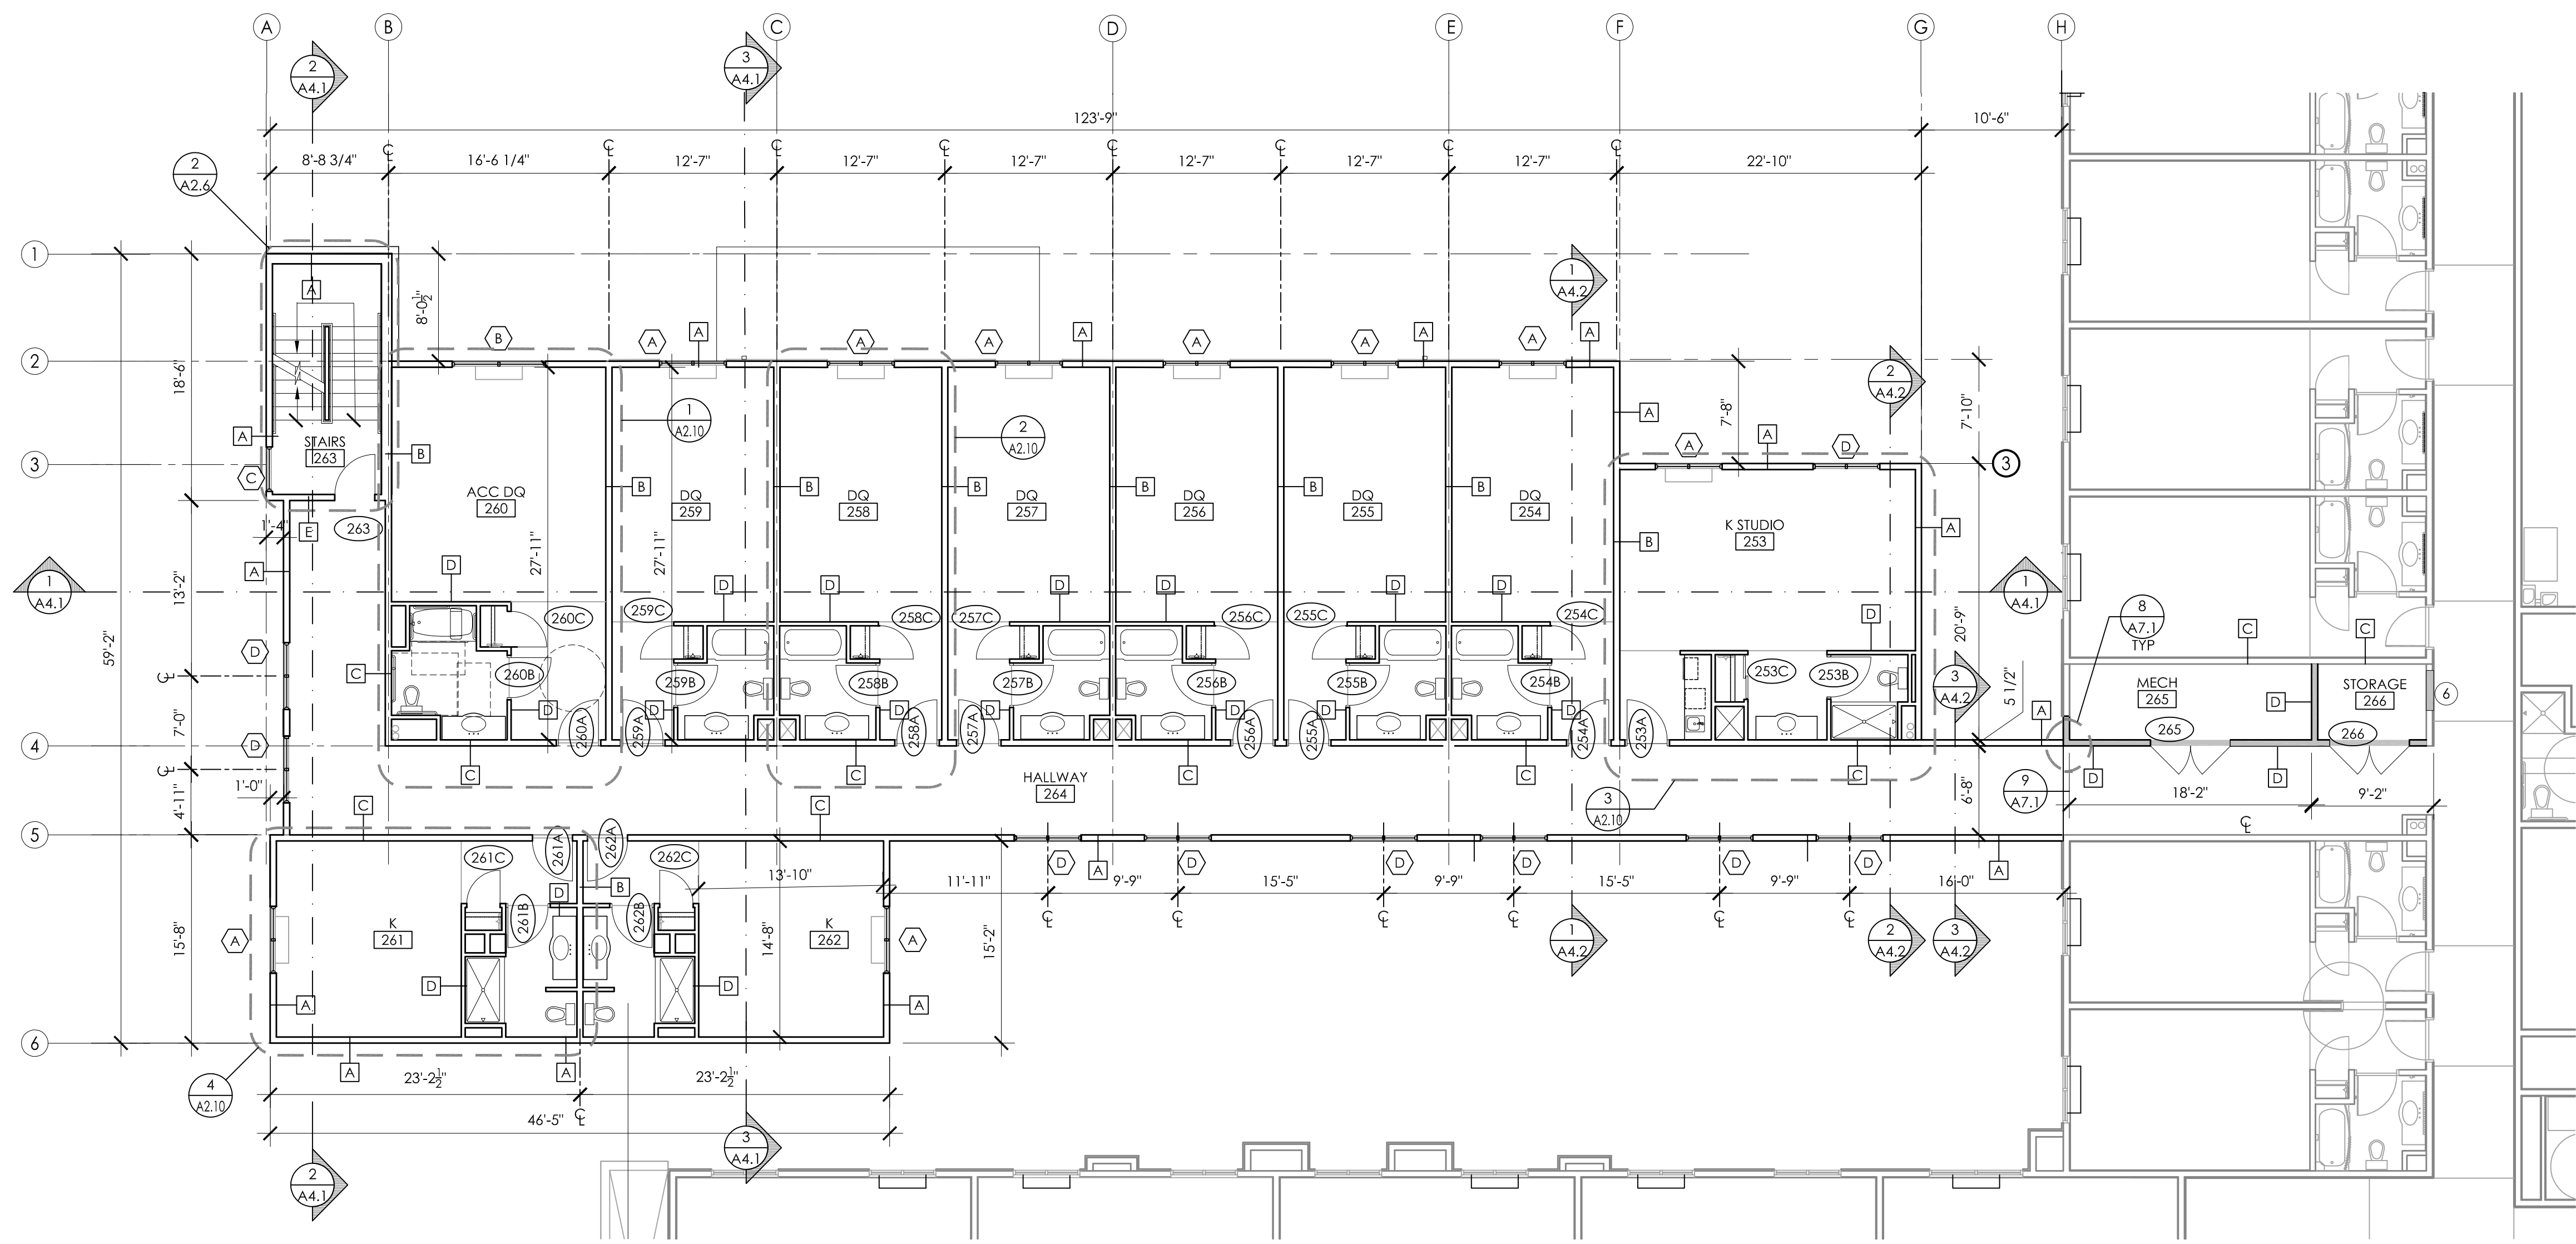

**2ND FLOOR PLAN**  
 24 x 36 - 1/8" = 1'-0"  
 12 x 18 - 1/16" = 1'-0"

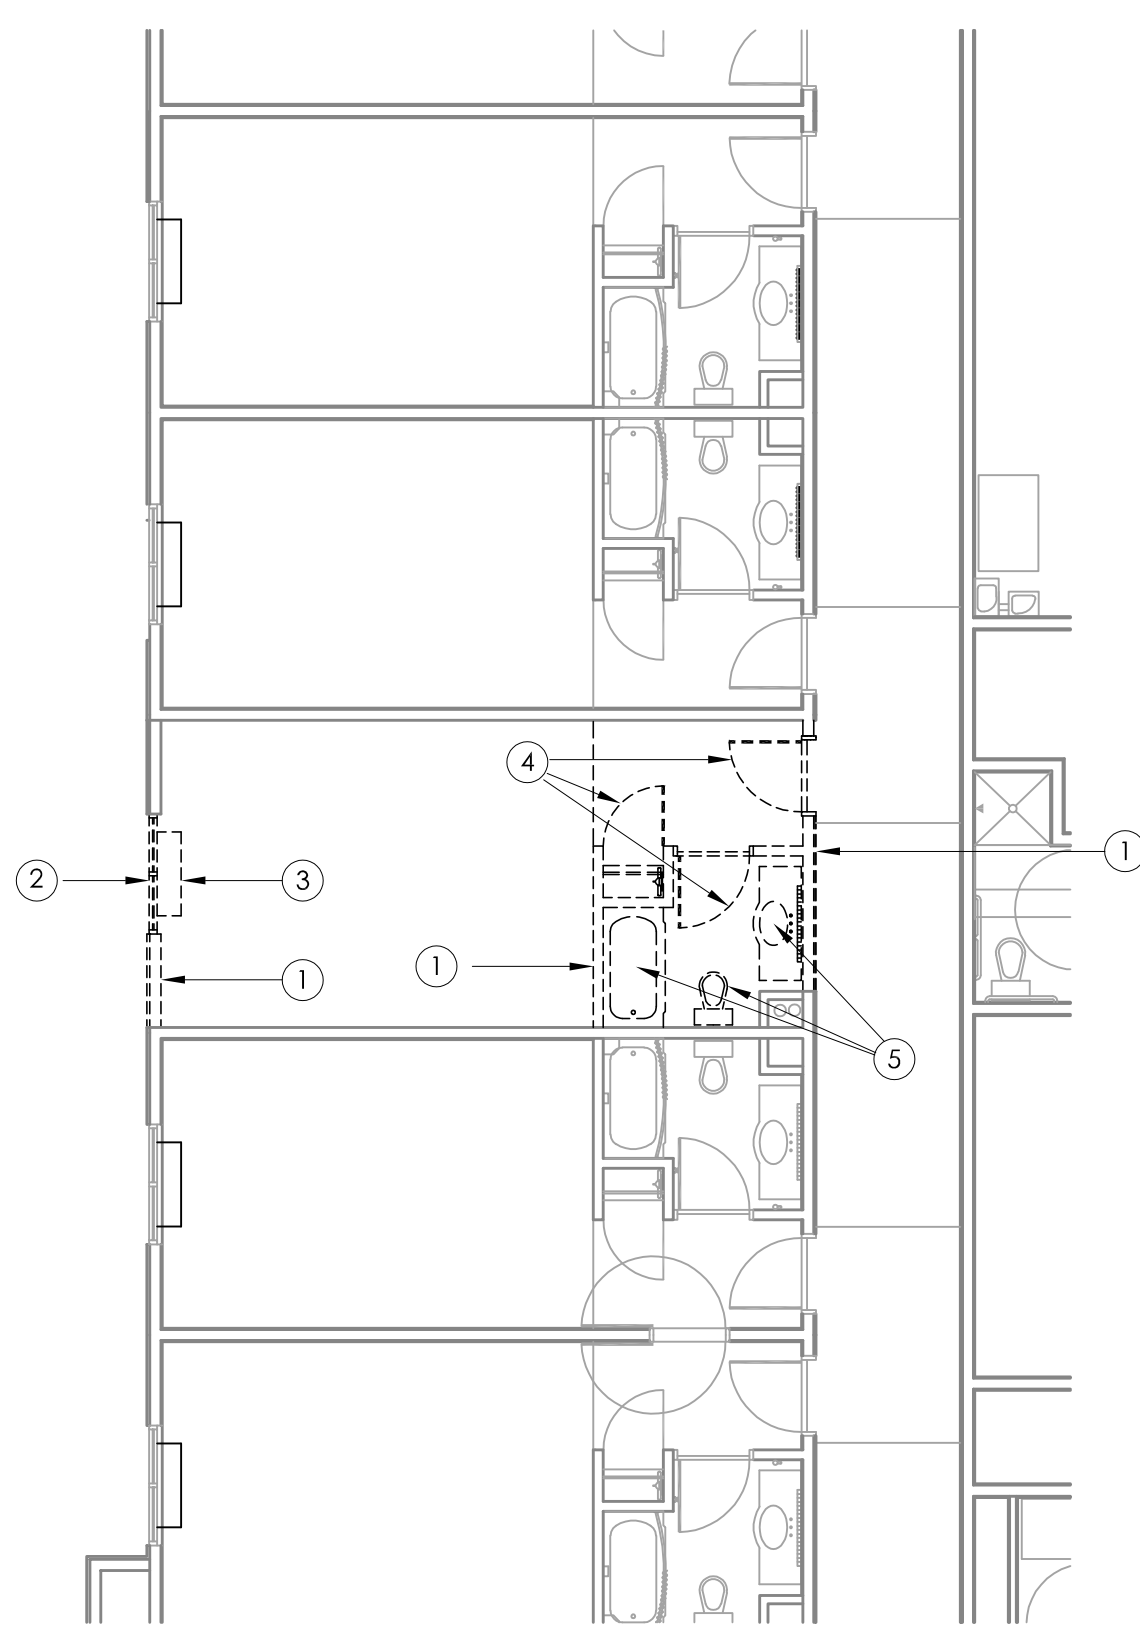

**SELECTIVE DEMO PLAN - 2ND FLOOR**  
 24 x 36 - 1/8" = 1'-0"  
 12 x 18 - 1/16" = 1'-0"

**GENERAL NOTES**

- SEE SHEETS A2.10 THRU 2.13 FOR ENLARGED PLANS AND INTERIOR ELEVATIONS.
- DIM . . . . . SEE A2.4 FOR REST OF NOTE

**LEGEND**

- - WALL TYPE, SEE SHEET A0.3
- (E) EXISTING
- - DOOR #
- ◡ - WINDOW #

**ROOM DESIGNATIONS**

- DQ DOUBLE QUEEN
- ACC DQ ACCESSIBLE DOUBLE QUEEN
- K KING
- (E) EXISTING

**City of Puyallup**  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

**KEY NOTES**

- REMOVE (E) WALL TYP. @ DASHED WALLS
- REMOVE (E) WINDOW
- REMOVE (E) A/C UNIT
- REMOVE (E) DOORS AND DOOR FRAMES
- REMOVE (E) LAVATORY, WATER CLOSET, AND BATHTUB/SHOWER.
- INFILL WALL WHERE DOOR WAS DEMOLISHED

**AUSTINCINA**  
 architects p.s.


12202 Pacific Ave. Suite C  
 Tacoma, Washington 98444  
 P: 253.531.4300 F: 253.537.6542  
 E: architects@austincina.com

3872 REGISTERED ARCHITECT  
 STATE OF WASHINGTON

**2ND FLOOR PLAN**  
**SELECTIVE DEMO PLAN - 2ND FLOOR**  
 Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA

Job #:  
 Date: January 6, 2020  
 Revs:



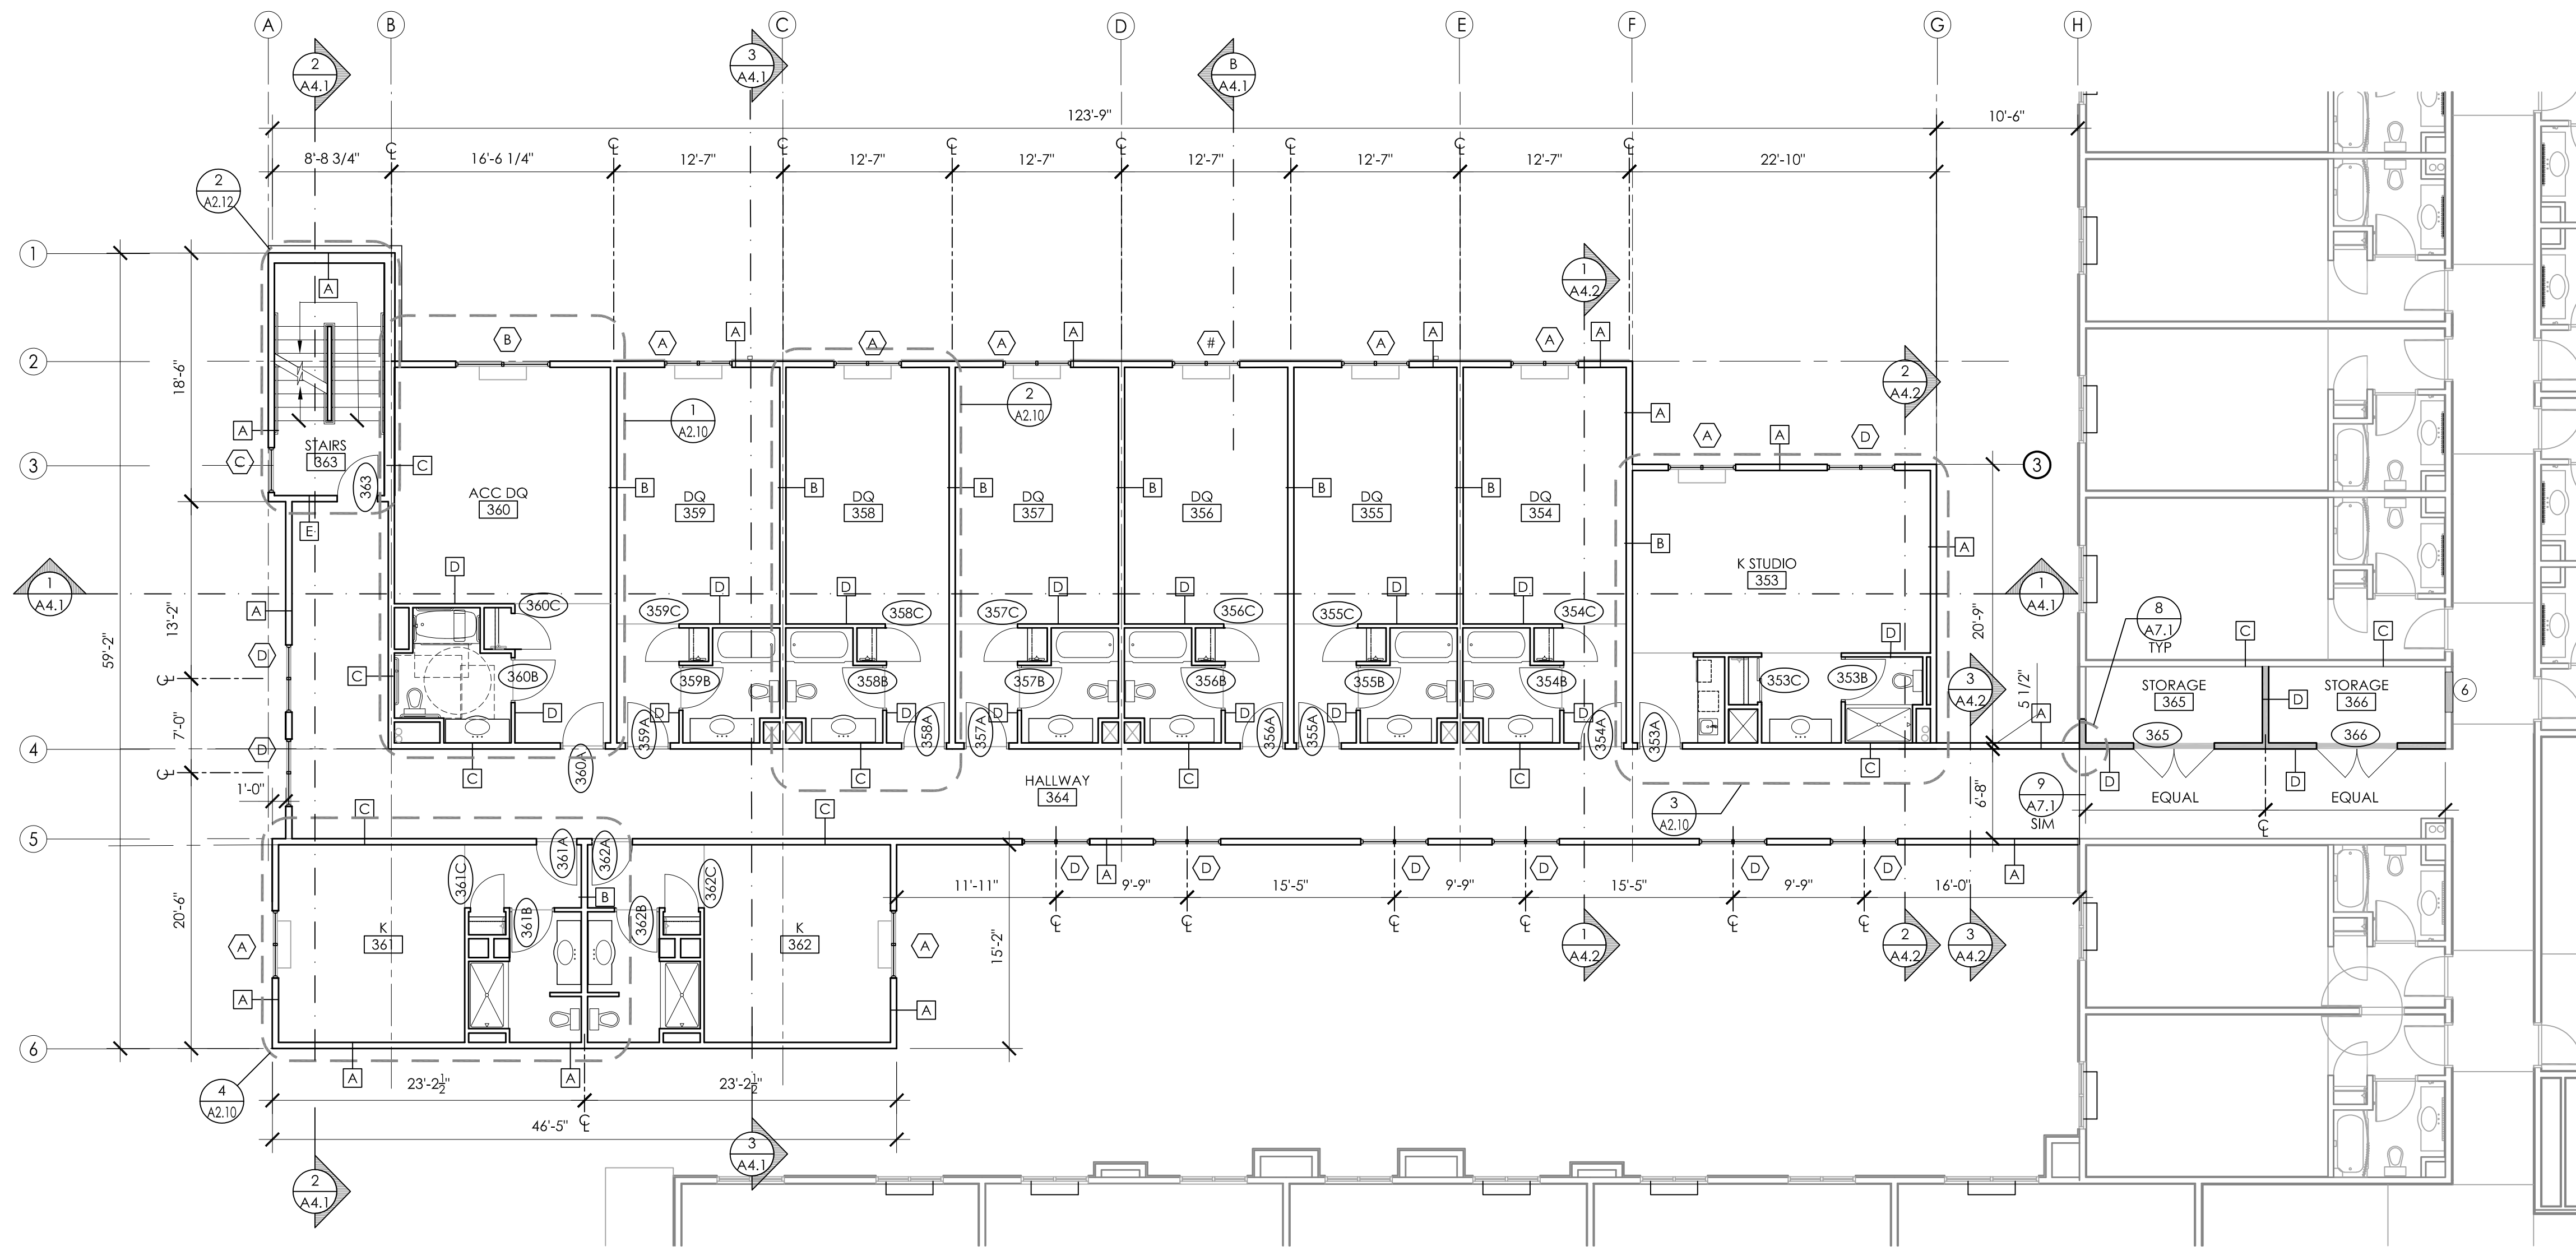

**3RD FLOOR PLAN**  
 24 x 36 - 1/8" = 1'-0"  
 12 x 18 - 1/16" = 1'-0"

**GENERAL NOTES**

- SEE SHEETS A2.10 THRU 2.13 FOR ENLARGED PLANS AND INTERIOR ELEVATIONS.
- DIM . . . . . (SEE A2.4)

**LEGEND**


- WALL TYPE, SEE SHEET A0.3
- (E) EXISTING
- DOOR #
- WINDOW #

**ROOM DESIGNATIONS**

- DQ DOUBLE QUEEN
- ACC DQ ACCESSIBLE DOUBLE QUEEN
- K KING
- (E) EXISTING

**City of Puyallup**  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

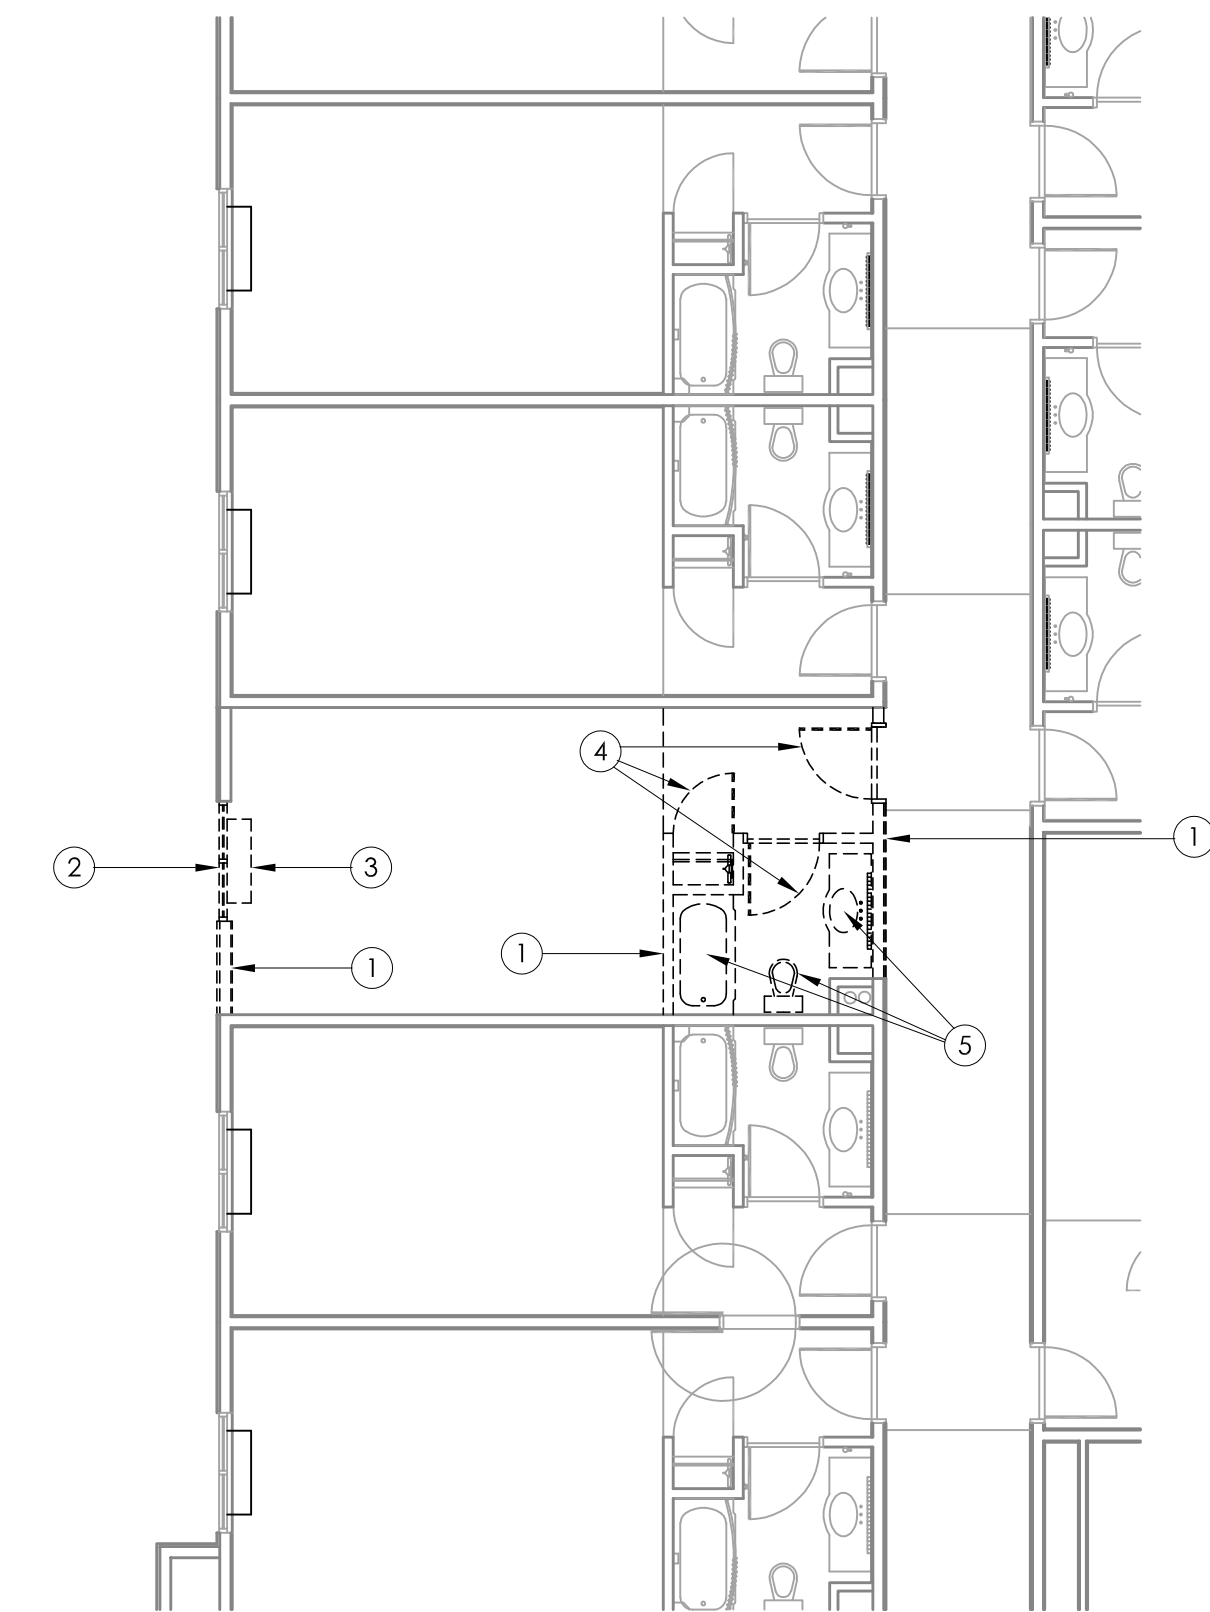


**SELECTIVE DEMO PLAN - 3RD FLOOR**  
 24 x 36 - 1/8" = 1'-0"  
 12 x 18 - 1/16" = 1'-0"

**KEY NOTES**

- REMOVE (E) WALL TYP. @ DASHED WALLS
- REMOVE (E) WINDOW
- REMOVE (E) A/C UNIT
- REMOVE (E) DOORS AND DOOR FRAMES
- REMOVE (E) LAVATORY, WATER CLOSET, AND BATHTUB/SHOWER.
- INFILL WALL WHERE DOOR WAS DEMOLISHED MATCH ALL FINISHES




12202 Pacific Ave. Suite C  
 Tacoma, Washington 98444  
 P: 253.531.4300 F: 253.537.6542  
 E: architects@austincina.com

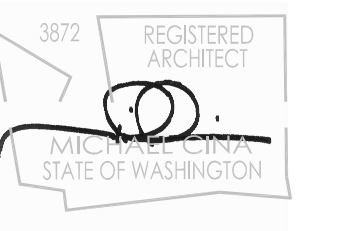

**3RD FLOOR PLAN**  
**SELECTIVE DEMO PLAN - 3RD FLOOR**  
 Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA

Job #:  
 Date: January 6, 2020  
 Revs:

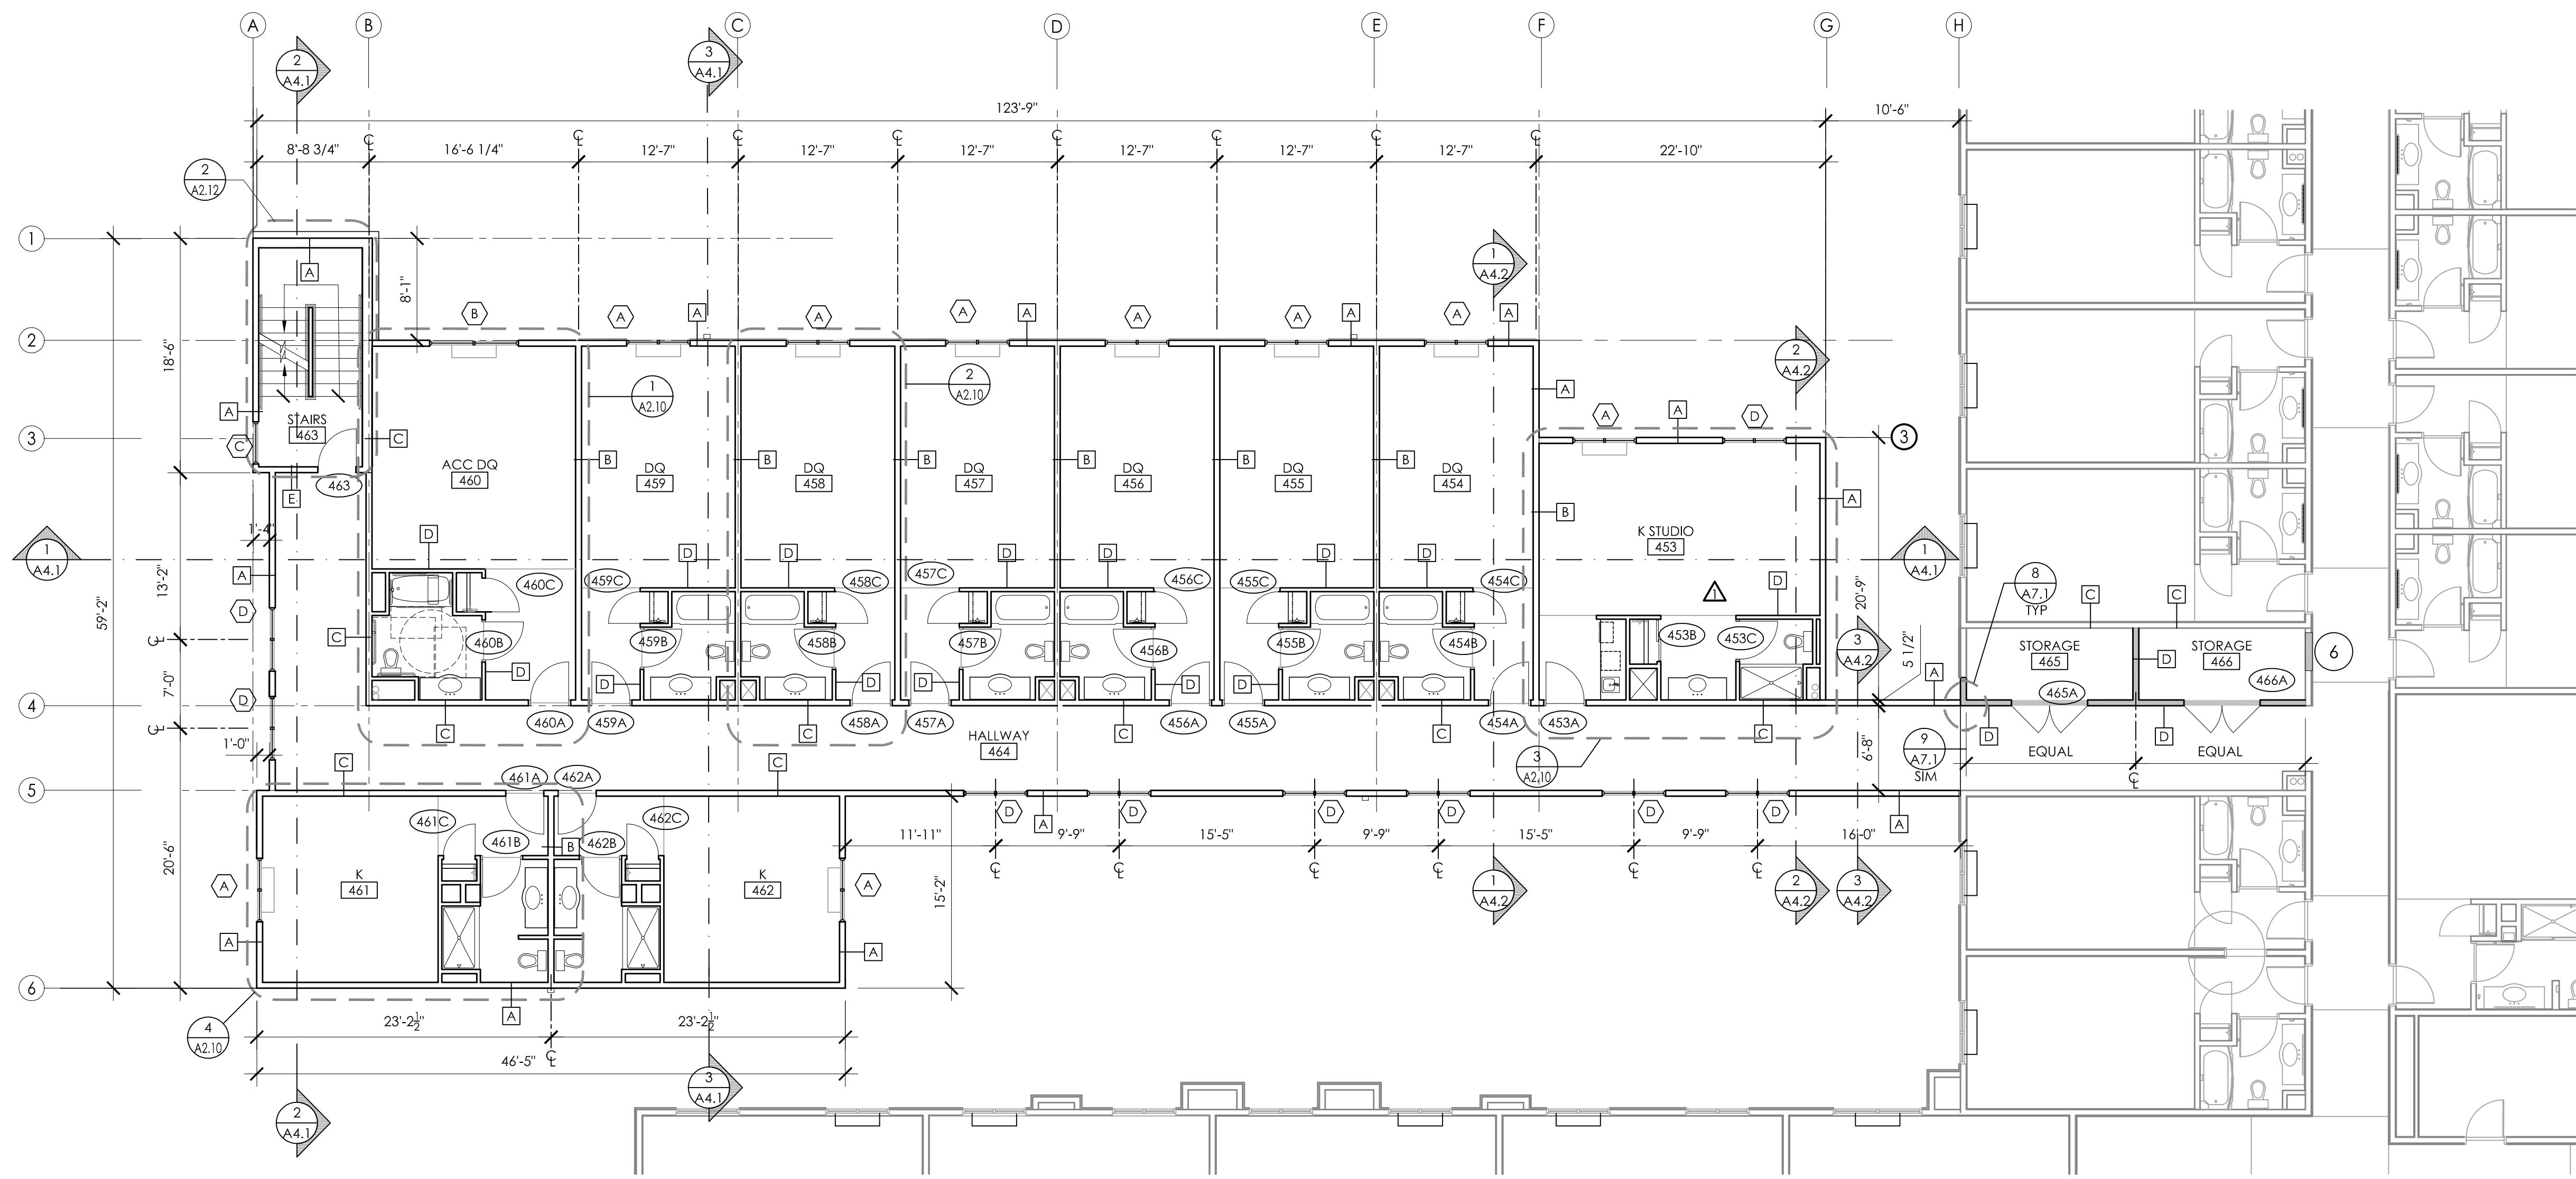

**4TH FLOOR PLAN**  
 24 x 36 - 1/8" = 1'-0"  
 12 x 18 - 1/16" = 1'-0"

**GENERAL NOTES**

- SEE SHEETS A2.10 THRU 2.13 FOR ENLARGED PLANS AND INTERIOR ELEVATIONS.
- DIMENSIONS ARE TO FACE OF STUDS UNLESS NOTED OTHERWISE.

**LEGEND**


- - WALL TYPE, SEE SHEET A0.3
- (E) EXISTING
- - DOOR #
- ◡ - WINDOW #

**ROOM DESIGNATIONS**

- DQ DOUBLE QUEEN
- ACC DQ ACCESSIBLE DOUBLE QUEEN
- K KING
- (E) EXISTING

**City of Puyallup**  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

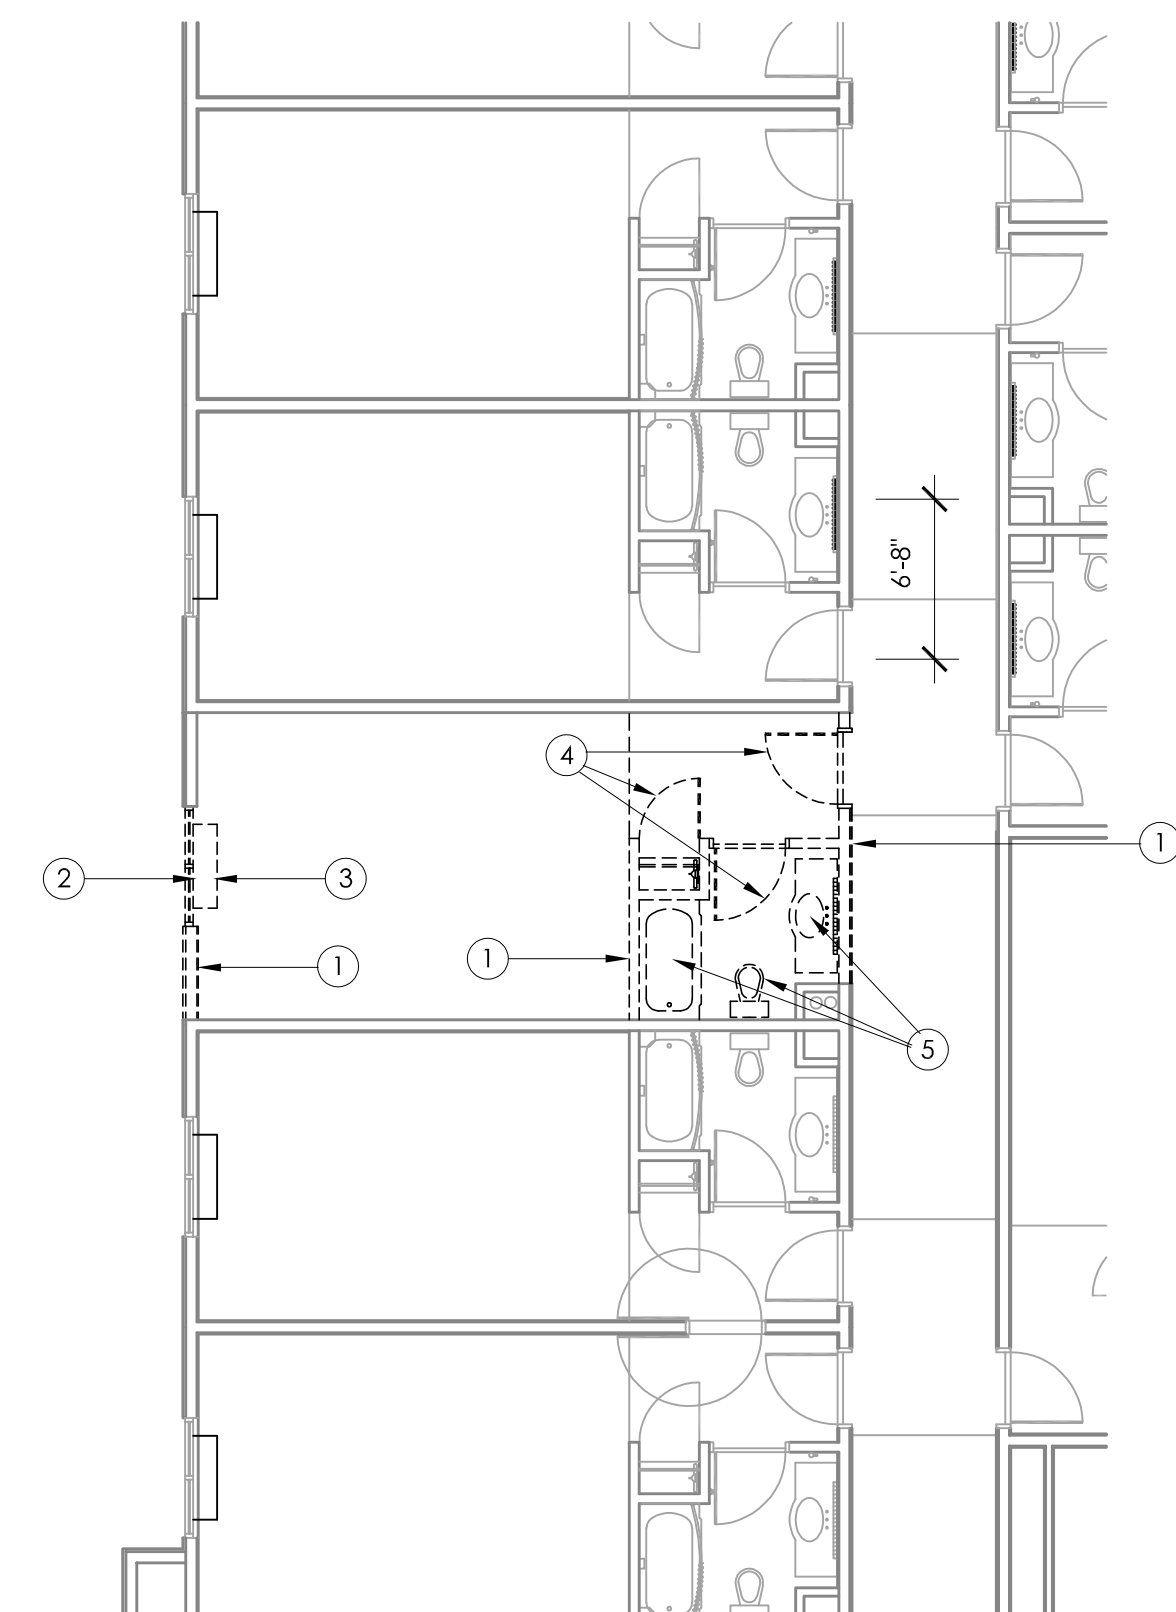

**KEY NOTES**

- REMOVE (E) WALL TYP. @ DASHED WALLS
- REMOVE (E) WINDOW
- REMOVE (E) A/C UNIT
- REMOVE (E) DOORS AND DOOR FRAMES
- REMOVE (E) LAVATORY, WATER CLOSET, AND BATHTUB/SHOWER.
- INFILL WALL WHERE DOOR WAS DEMOLISHED MATCH ALL FINISHES

**SELECTIVE DEMO PLAN - 4TH FLOOR**  
 24 x 36 - 1/8" = 1'-0"  
 12 x 18 - 1/16" = 1'-0"


**AUSTINCINA**  
 architects p.s.

12202 Pacific Ave. Suite C  
 Tacoma, Washington 98444  
 P: 253.531.4300 F: 253.537.6542  
 E: architects@austincina.com

3872 REGISTERED ARCHITECT  
 ARCHITECTS  
 STATE OF WASHINGTON

**4TH FLOOR PLAN**  
**SELECTIVE DEMO PLAN - 4TH FLOOR**  
 Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA

Job #:  
 Date: January 6, 2020  
 Revs:

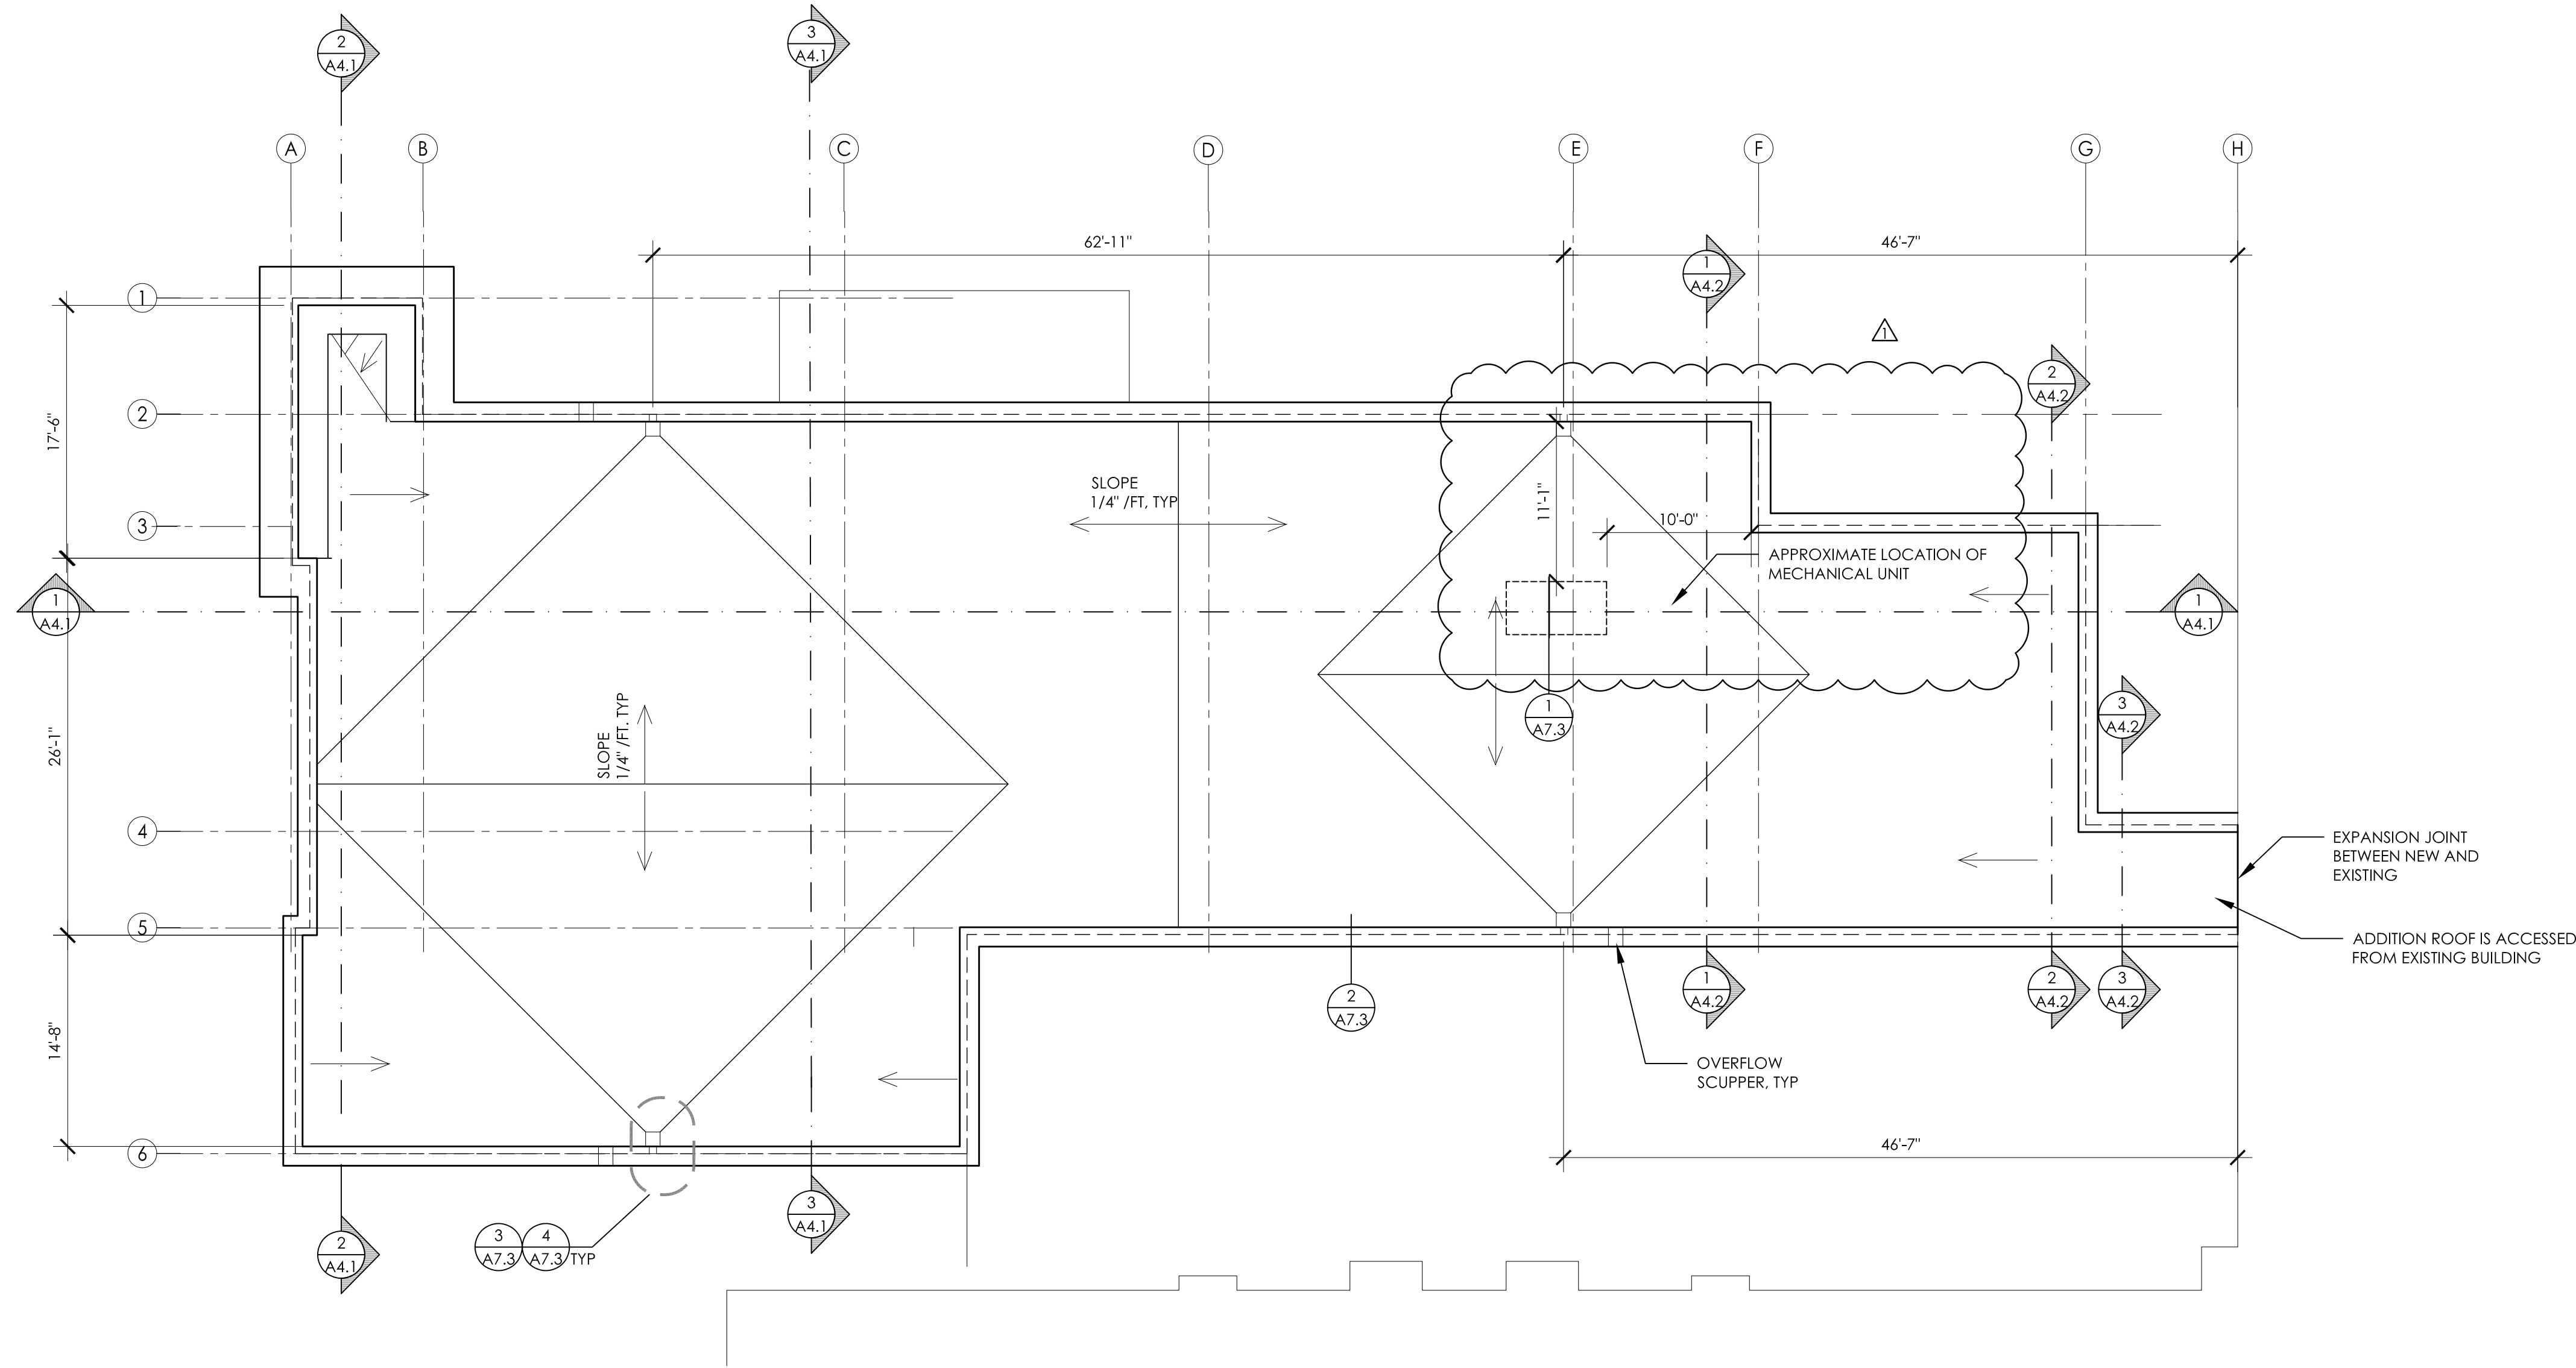


**ROOF PLAN**  
 24 x 36 - 1/8" = 1'-0"  
 12 x 18 - 1/16" = 1'-0"

**ROOF DRAINAGE CALCS**  
 100 YR STORM, 360 S.F. PER IN<sup>2</sup> OF D.S.  
 ROOF AREA 1:  
 1,276/360 = 3.54 IN<sup>2</sup> OF D.S. REQ. PROVIDED 25 IN<sup>2</sup>  
 ROOF AREA 2:  
 1,159/360 = 3.22 IN<sup>2</sup> OF D.S. REQ. PROVIDED 25 IN<sup>2</sup>  
 ROOF AREA 3:  
 1,572/360 = 4.36 IN<sup>2</sup> OF D.S. REQ. PROVIDED 25 IN<sup>2</sup>  
 ROOF AREA 4:  
 930 S.F./360 = 2.58 IN<sup>2</sup> OF D.S. REQ. PROVIDED 25 IN<sup>2</sup>



12202 Pacific Ave. Suite C  
 Tacoma, Washington 98444  
 P: 253.531.4300 F: 253.537.6542  
 E: architects@austincina.com

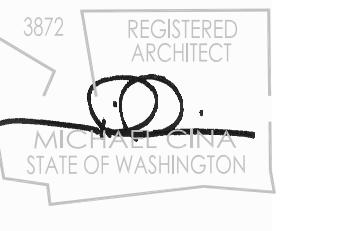

RESPONSE TO BUILDING REV.  
 COMMENT 03/10/20

**City of Puyallup**  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic


**ROOF PLAN**

Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA

Job #:  
 Date: January 6, 2020  
 Revs: March 10, 2020





GENERAL NOTES

1. FOR LIGHTING LAYOUT, SEE ELECTRICAL DRAWINGS



AUSTINCINA  
architects p.s.

12202 Pacific Ave. Suite C  
Tacoma, Washington 98444  
P: 253.531.4300 F: 253.537.6542  
E: architects@austincina.com

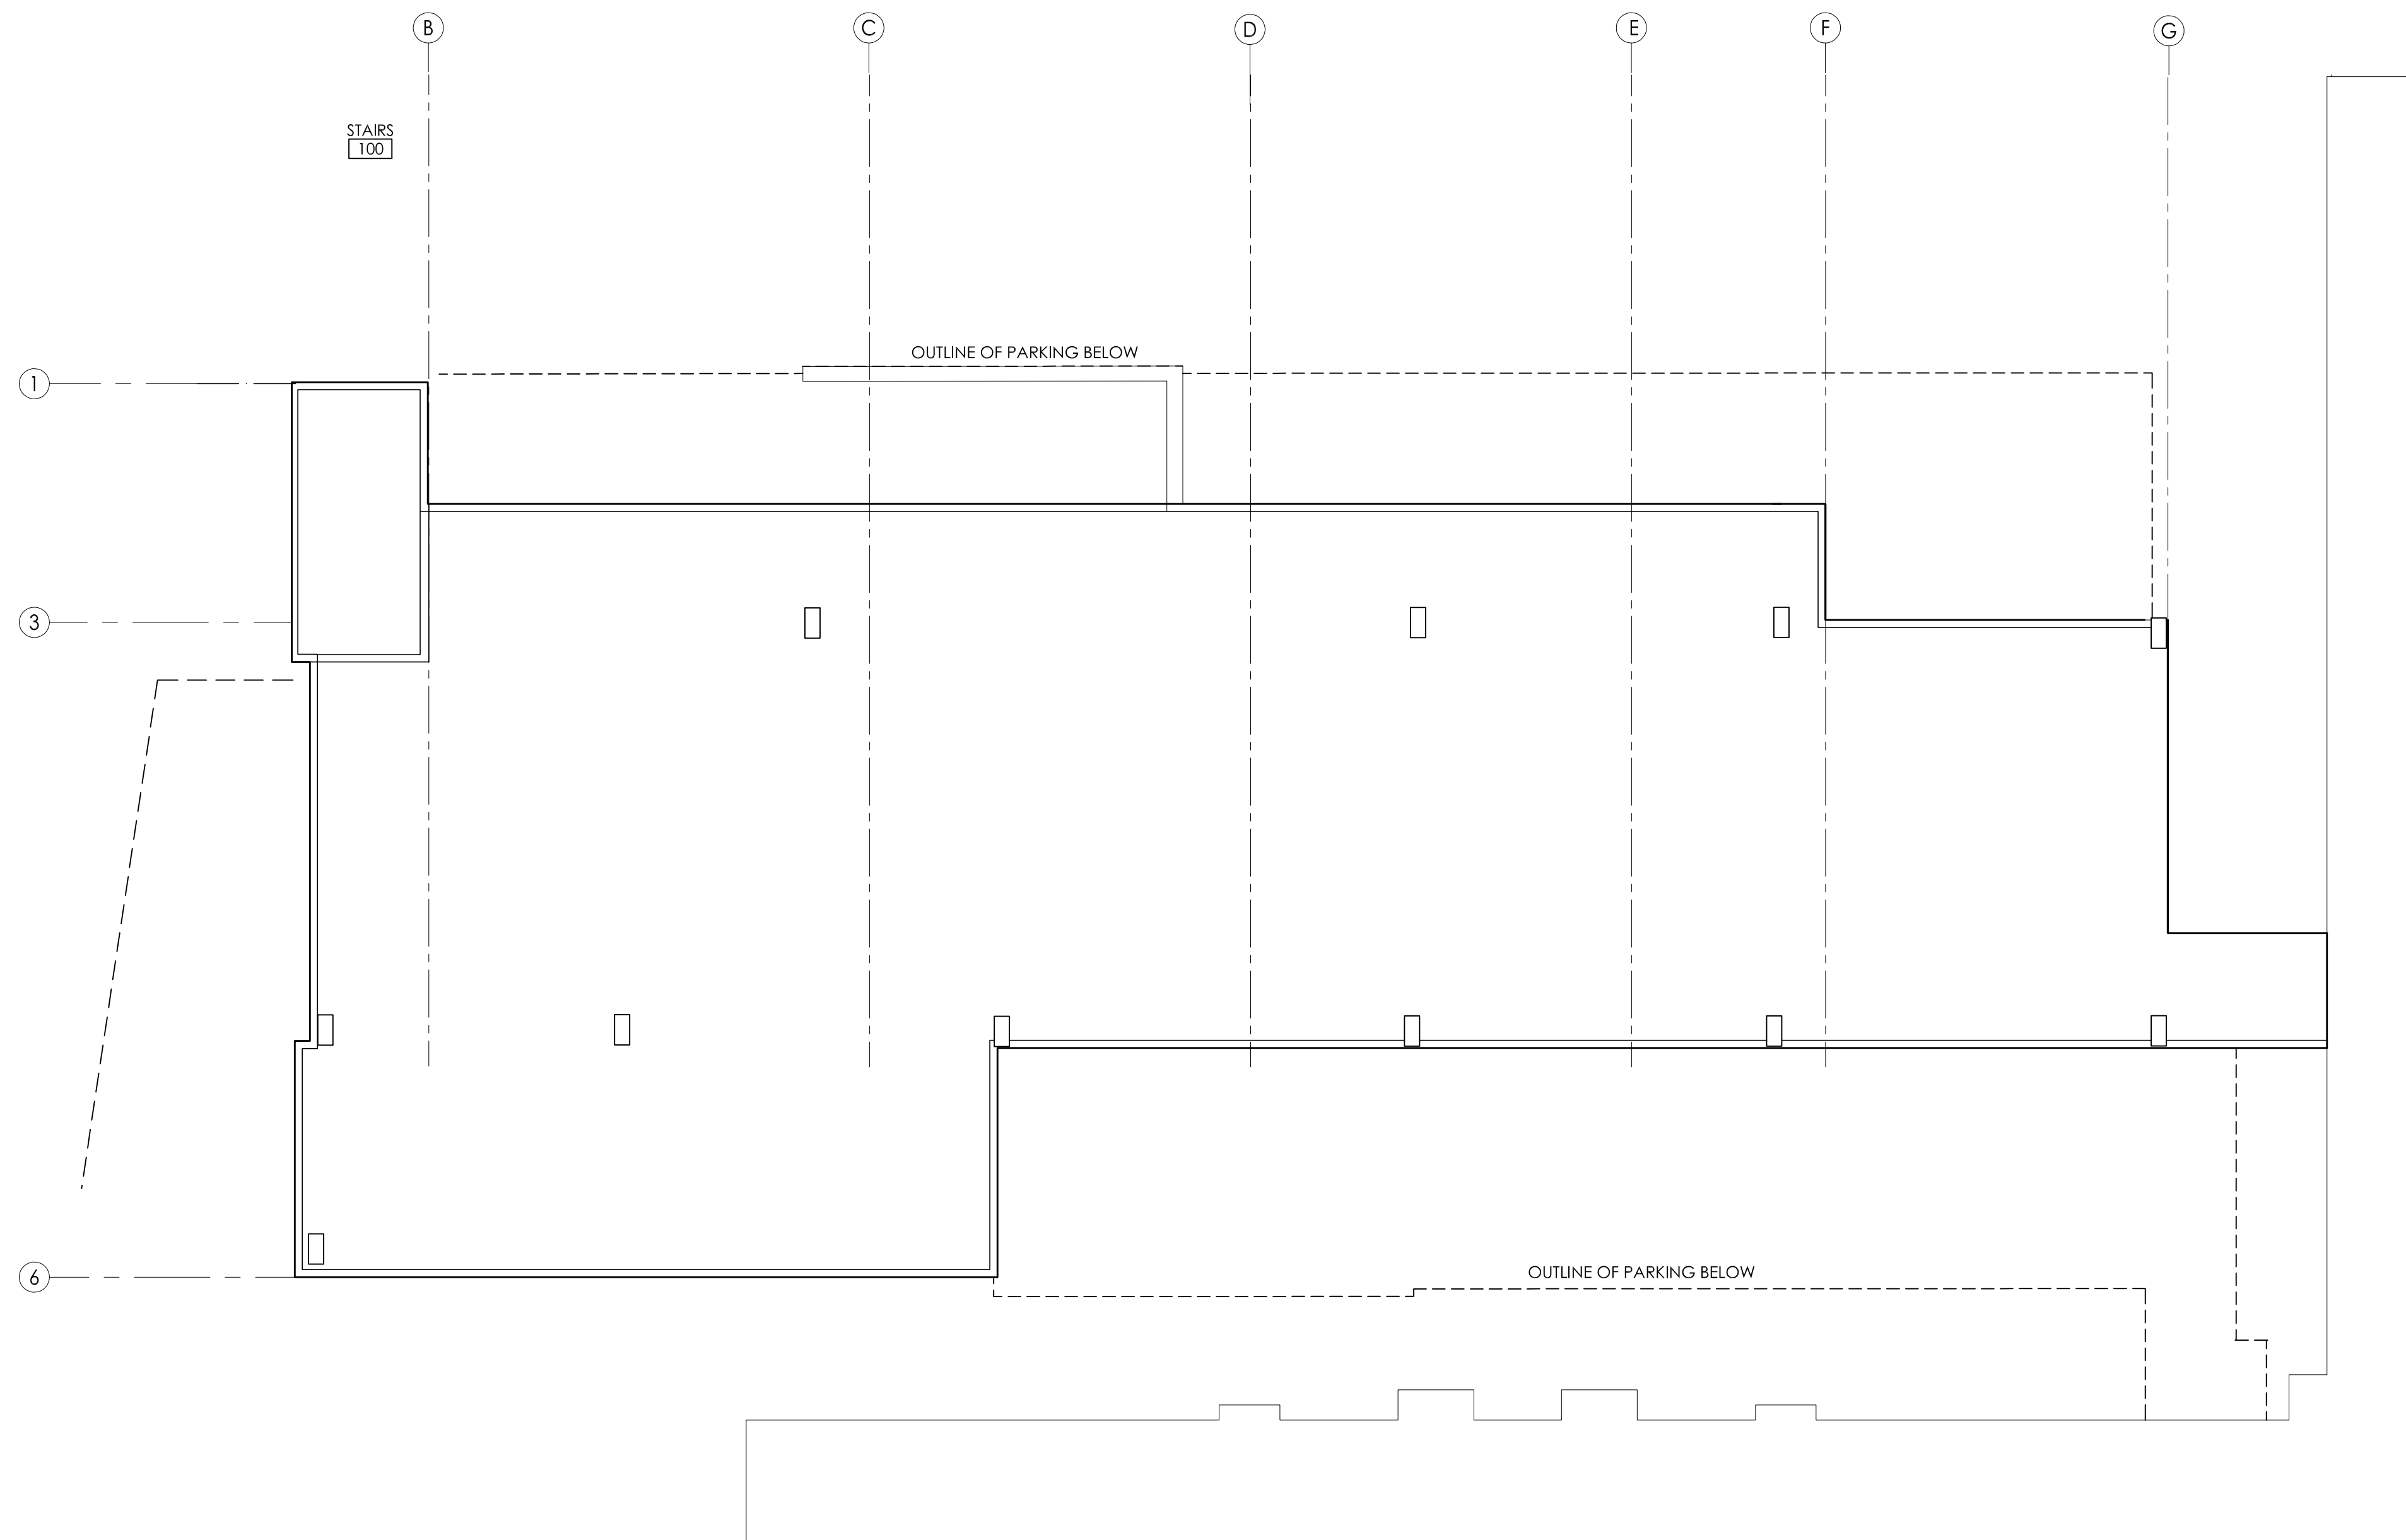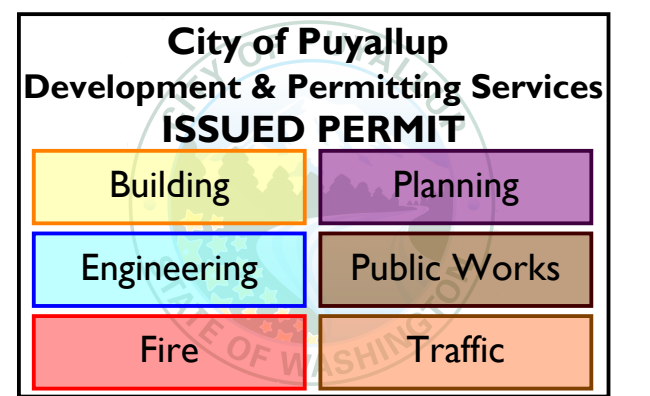



1ST FLOOR REFLECTED CEILING PLAN

24 x 36 - 1/8" = 1'-0"  
12 x 18 - 1/16" = 1'-0"

1ST FLOOR  
REFLECTED CEILING PLAN  
Addition to Hampton Inn & Suites  
Hampton Inn & Suites  
1515 S. Meridian, Puyallup, WA

Job #:  
Date: January 6, 2020  
Revs:

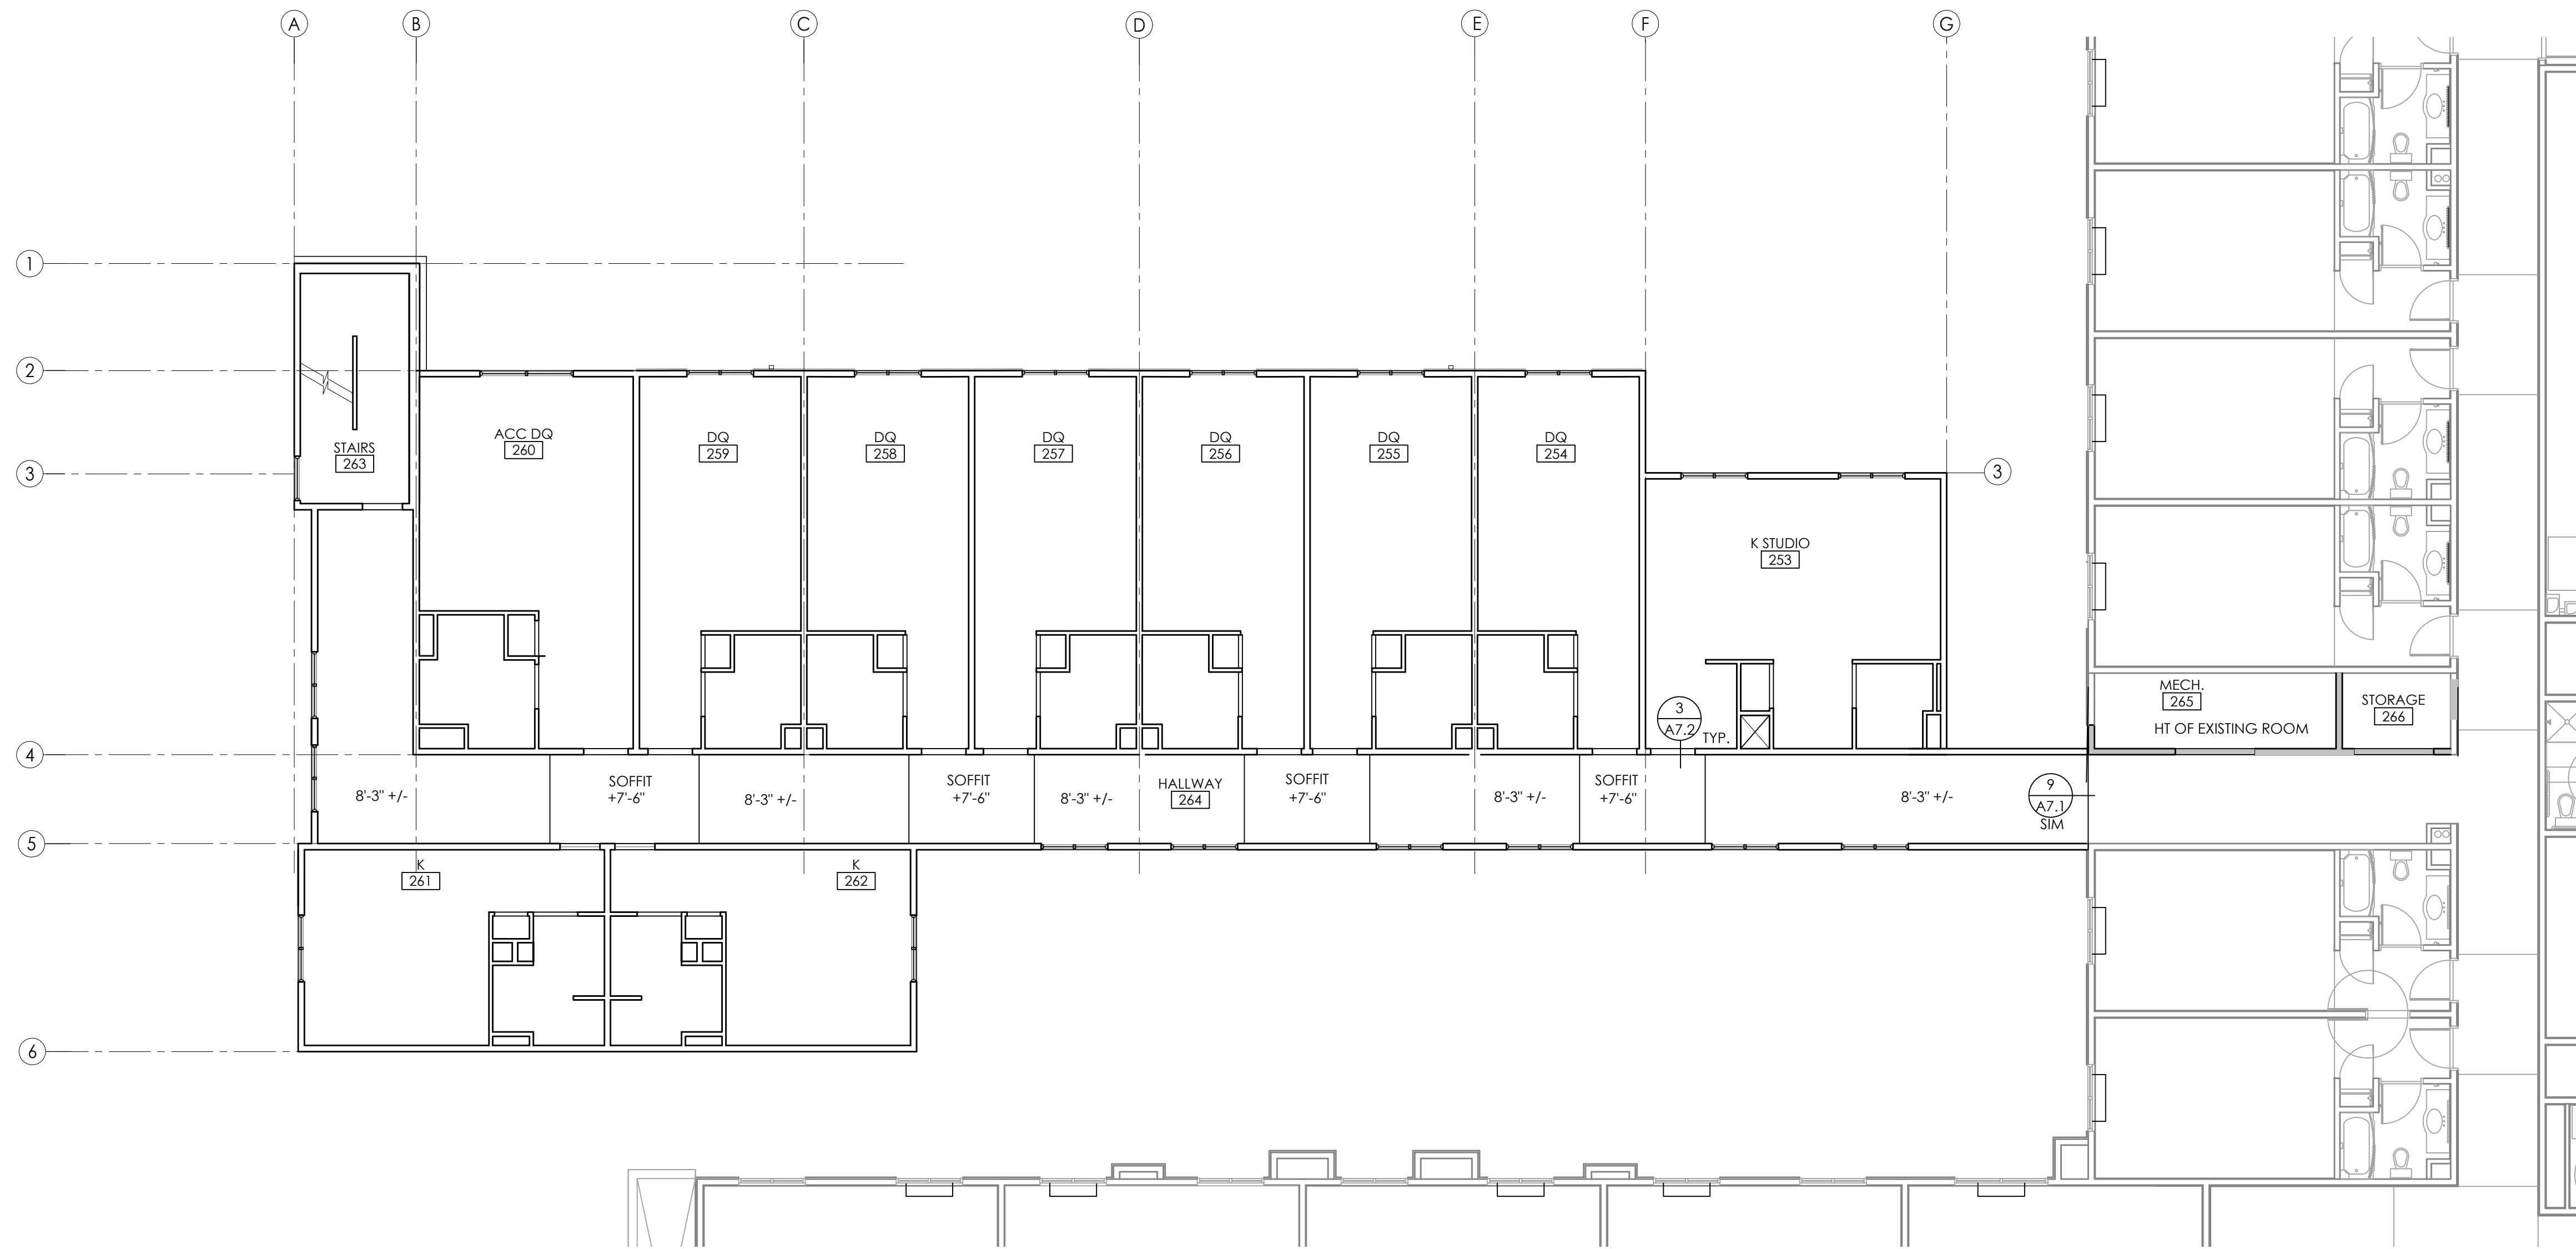

**2ND FLOOR REFLECTED CEILING PLAN**

24 x 36 - 1/8" = 1'-0"  
 12 x 18 - 1/16" = 1'-0"

**GENERAL NOTES**

1. FOR LIGHTING LAYOUT, SEE ELECTRICAL DRAWINGS


**LEGEND**

— NEW WALL IN EXISTING BLDG.



**AUSTINCINA**  
architects p.s.

12202 Pacific Ave. Suite C  
 Tacoma, Washington 98444  
 P: 253.531.4300 F: 253.537.6542  
 E: architects@austincina.com

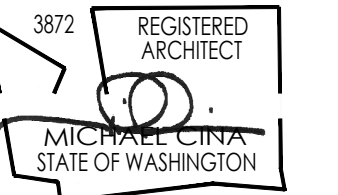


**City of Puyallup**  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

**2ND FLOOR REFLECTED CEILING PLAN**  
 Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA

Job #:  
 Date: January 6, 2020  
 Revs:

**A2.7**  
 PERMIT SET

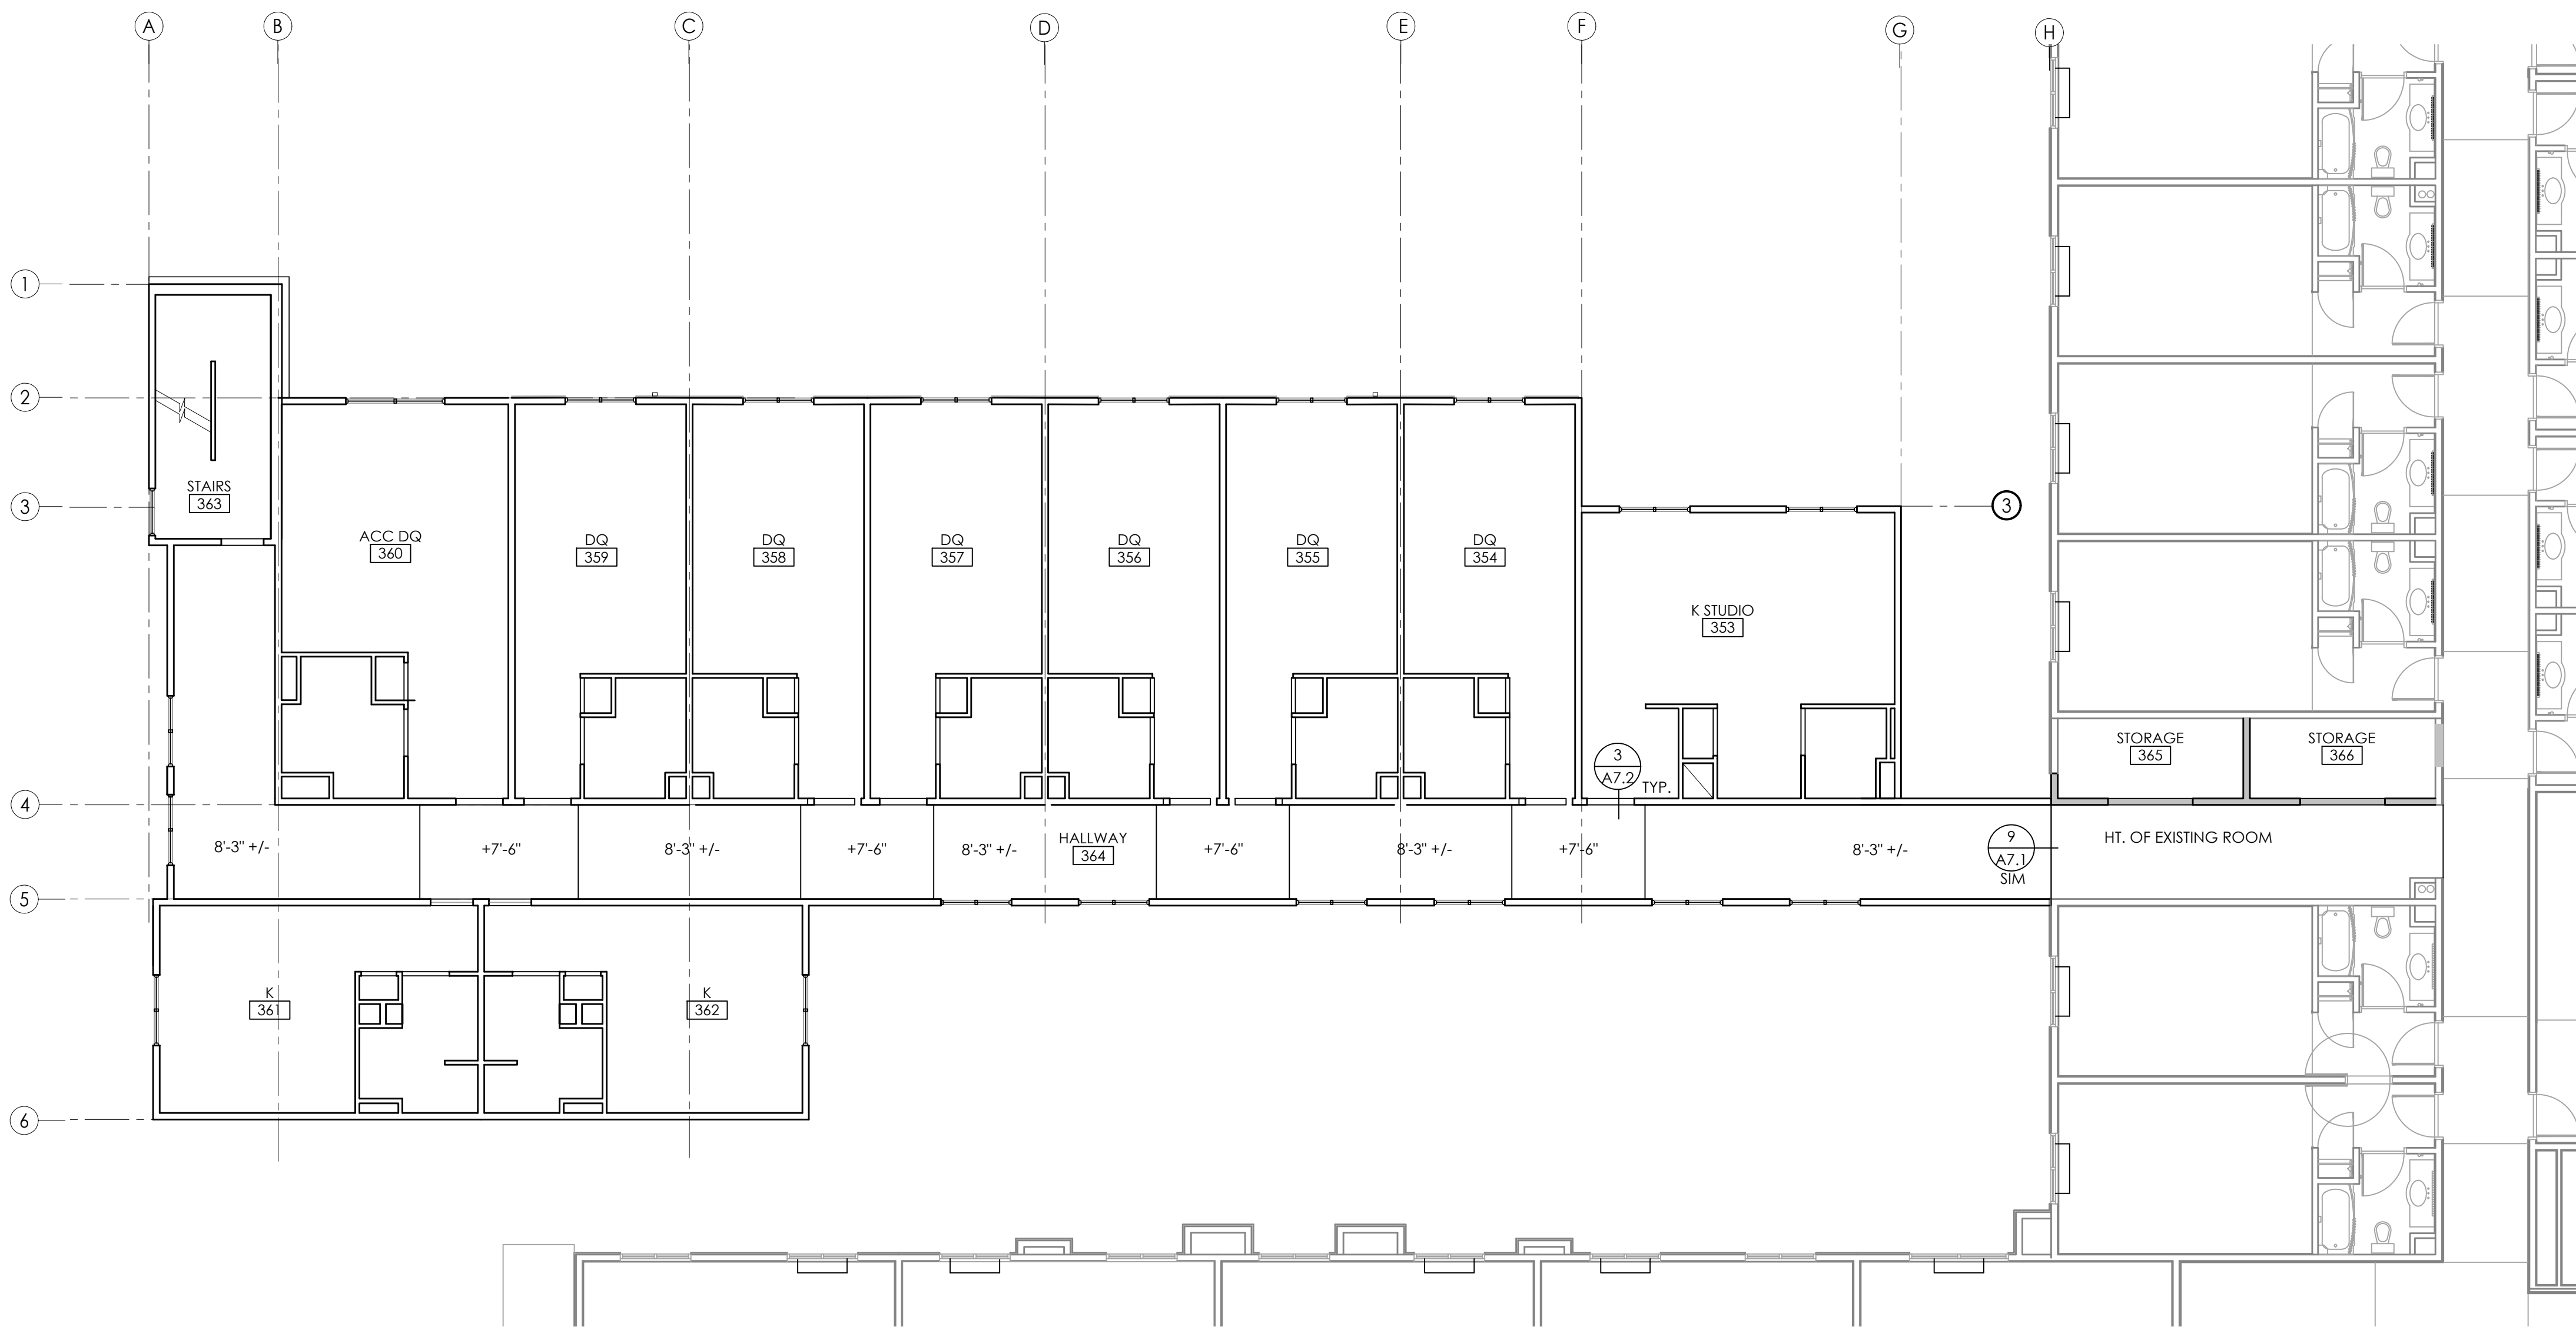


**GENERAL NOTES**  
 1. FOR LIGHTING LAYOUT, SEE ELECTRICAL DRAWINGS

**LEGEND**  
 ——— NEW WALL IN EXISTING BLDG.



12202 Pacific Ave. Suite C  
 Tacoma, Washington 98444  
 P: 253.531.4300 F: 253.537.6542  
 E: architects@austincina.com

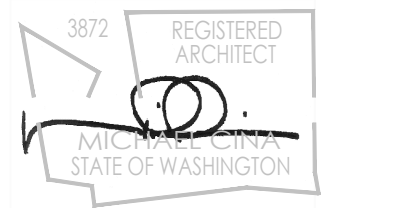

**City of Puyallup  
 Development & Permitting Services  
 ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

**3RD FLOOR REFLECTED CEILING PLAN**  
 24 x 36 - 1/8" = 1'-0"  
 12 x 18 - 1/16" = 1'-0"


**3RD FLOOR  
 REFLECTED CEILING PLAN**  
 Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA

Job #:  
 Date: January 6, 2020  
 Revs:



AUSTINCINA  
architects p.s.

12202 Pacific Ave. Suite C  
Tacoma, Washington 98444  
P: 253.531.4300 F: 253.537.6542  
E: architects@austincina.com

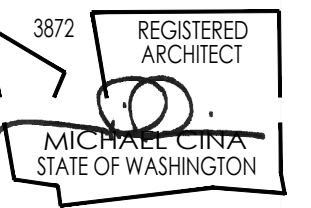

**GENERAL NOTES**



1. FOR LIGHTING LAYOUT, SEE ELECTRICAL DRAWINGS

**LEGEND**

NEW WALL IN EXISTING BLDG.

**City of Puyallup**  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

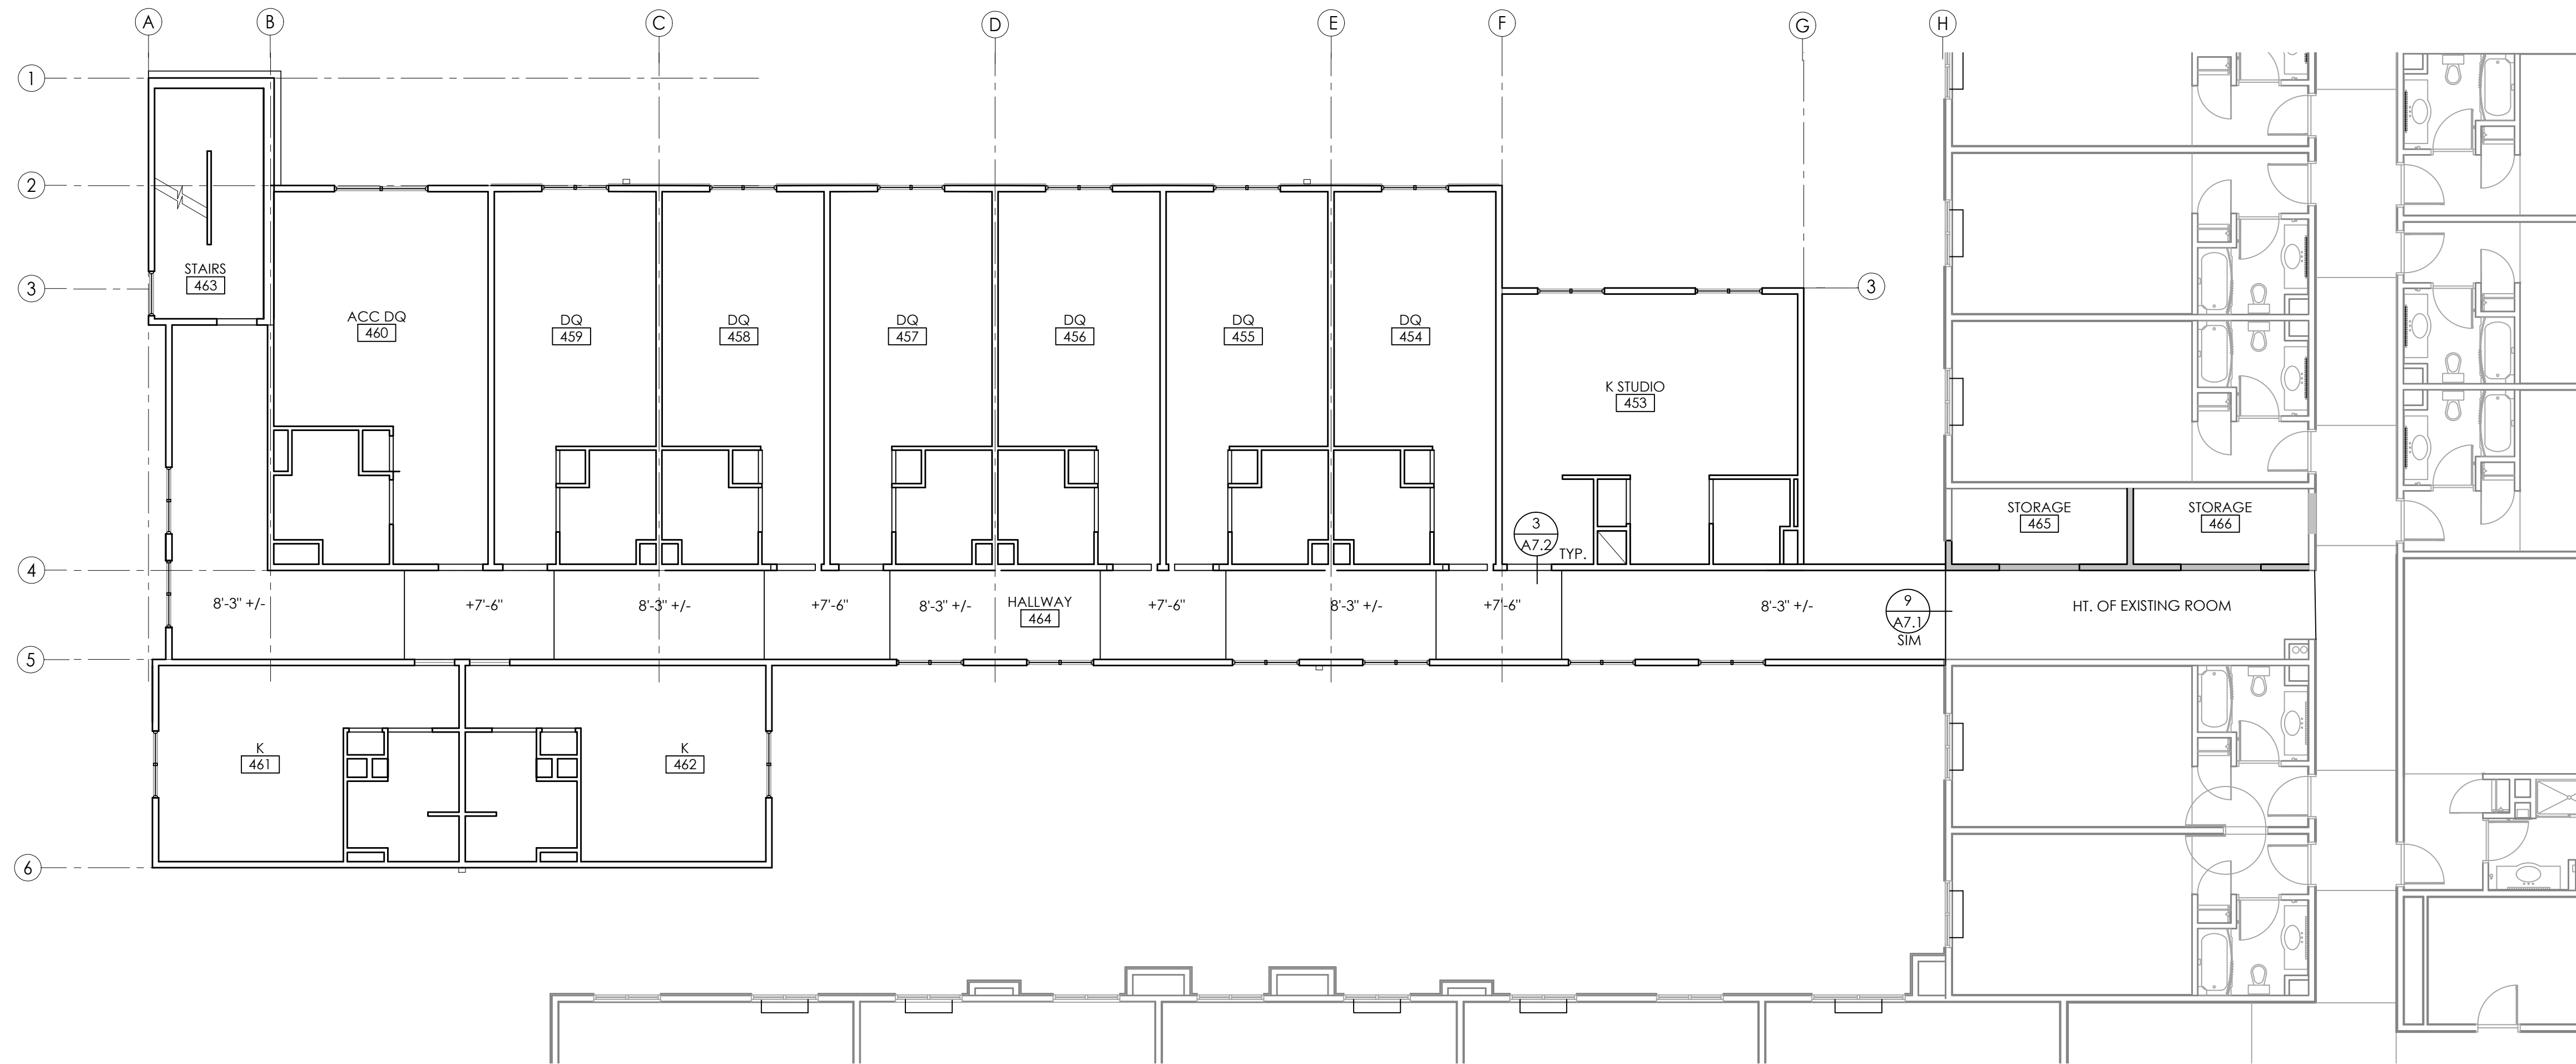


**4TH FLOOR REFLECTED CEILING PLAN**


24 x 36 - 1/8" = 1'-0"  
12 x 18 - 1/16" = 1'-0"

**4TH FLOOR  
REFLECTED CEILING PLAN**  
Addition to Hampton Inn & Suites  
Hampton Inn & Suites  
1515 S. Meridian, Puyallup, WA


Job #:  
Date: January 6, 2020  
Revs:

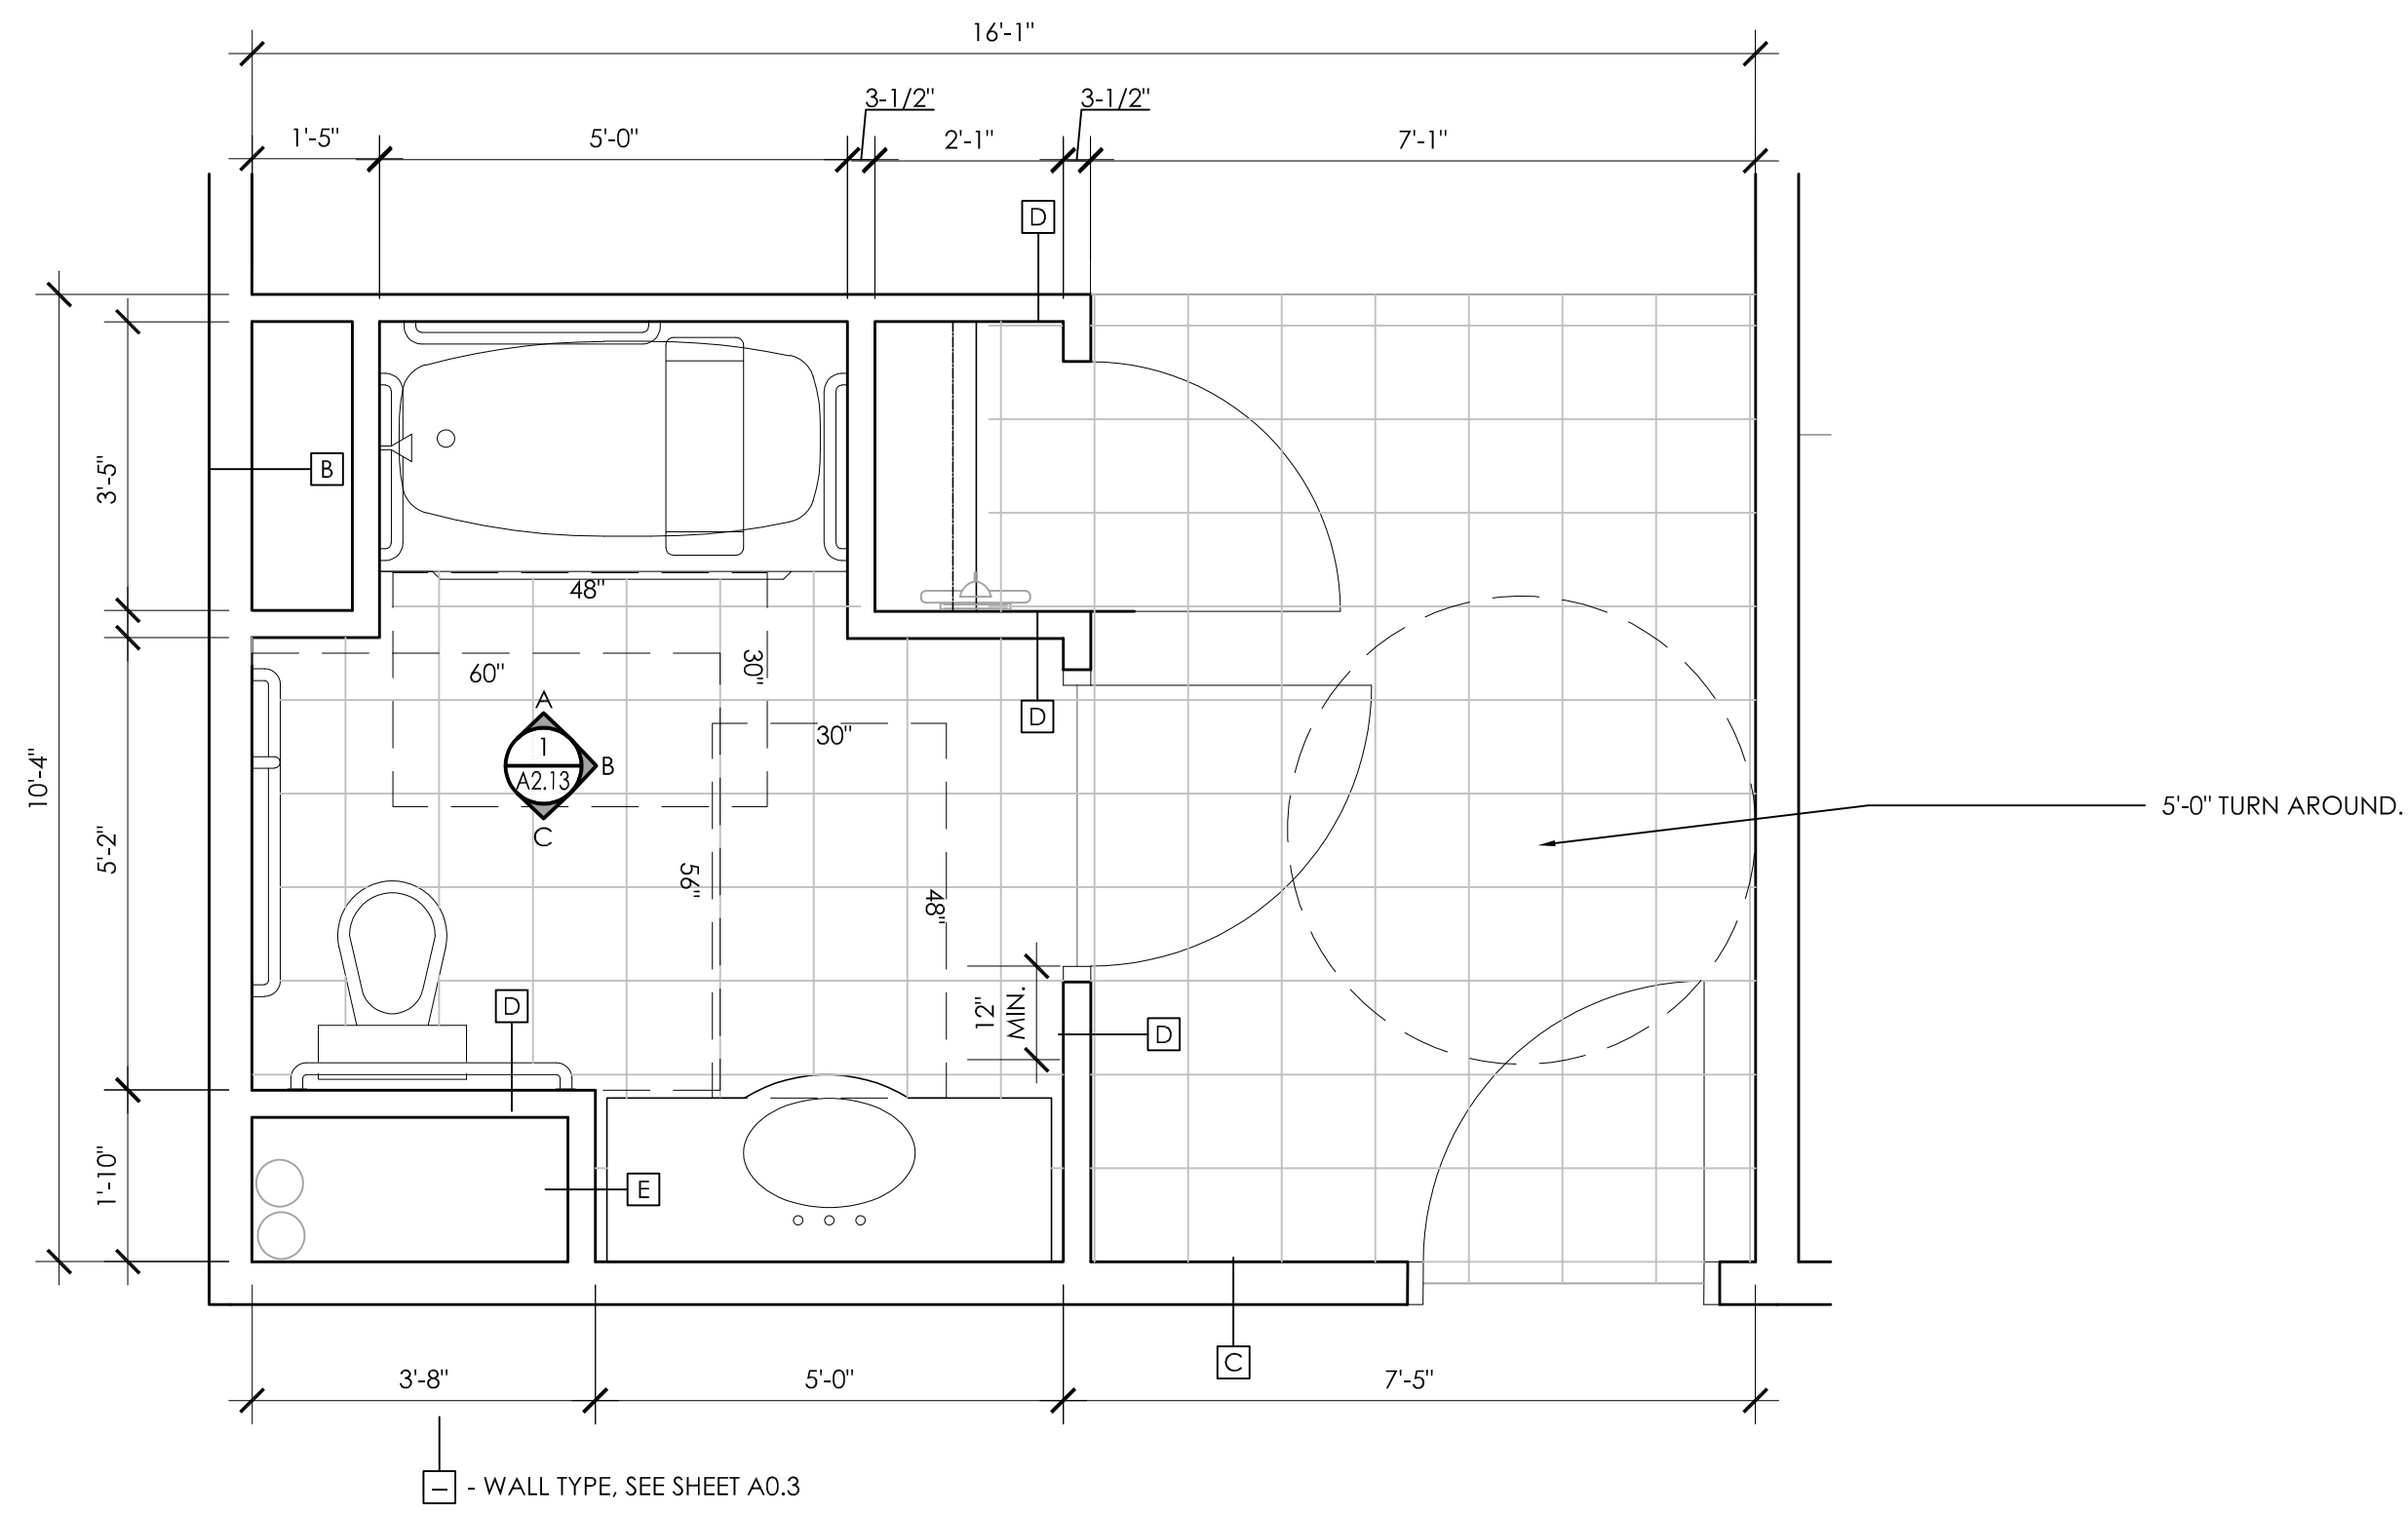


**1** TYPICAL ACCESSIBLE DOUBLE QUEEN GUEST ROOM BATH PLAN  
 $24 \times 36 - 1/2" = 1'-0"$   
 $12 \times 18 - 1/4" = 1'-0"$

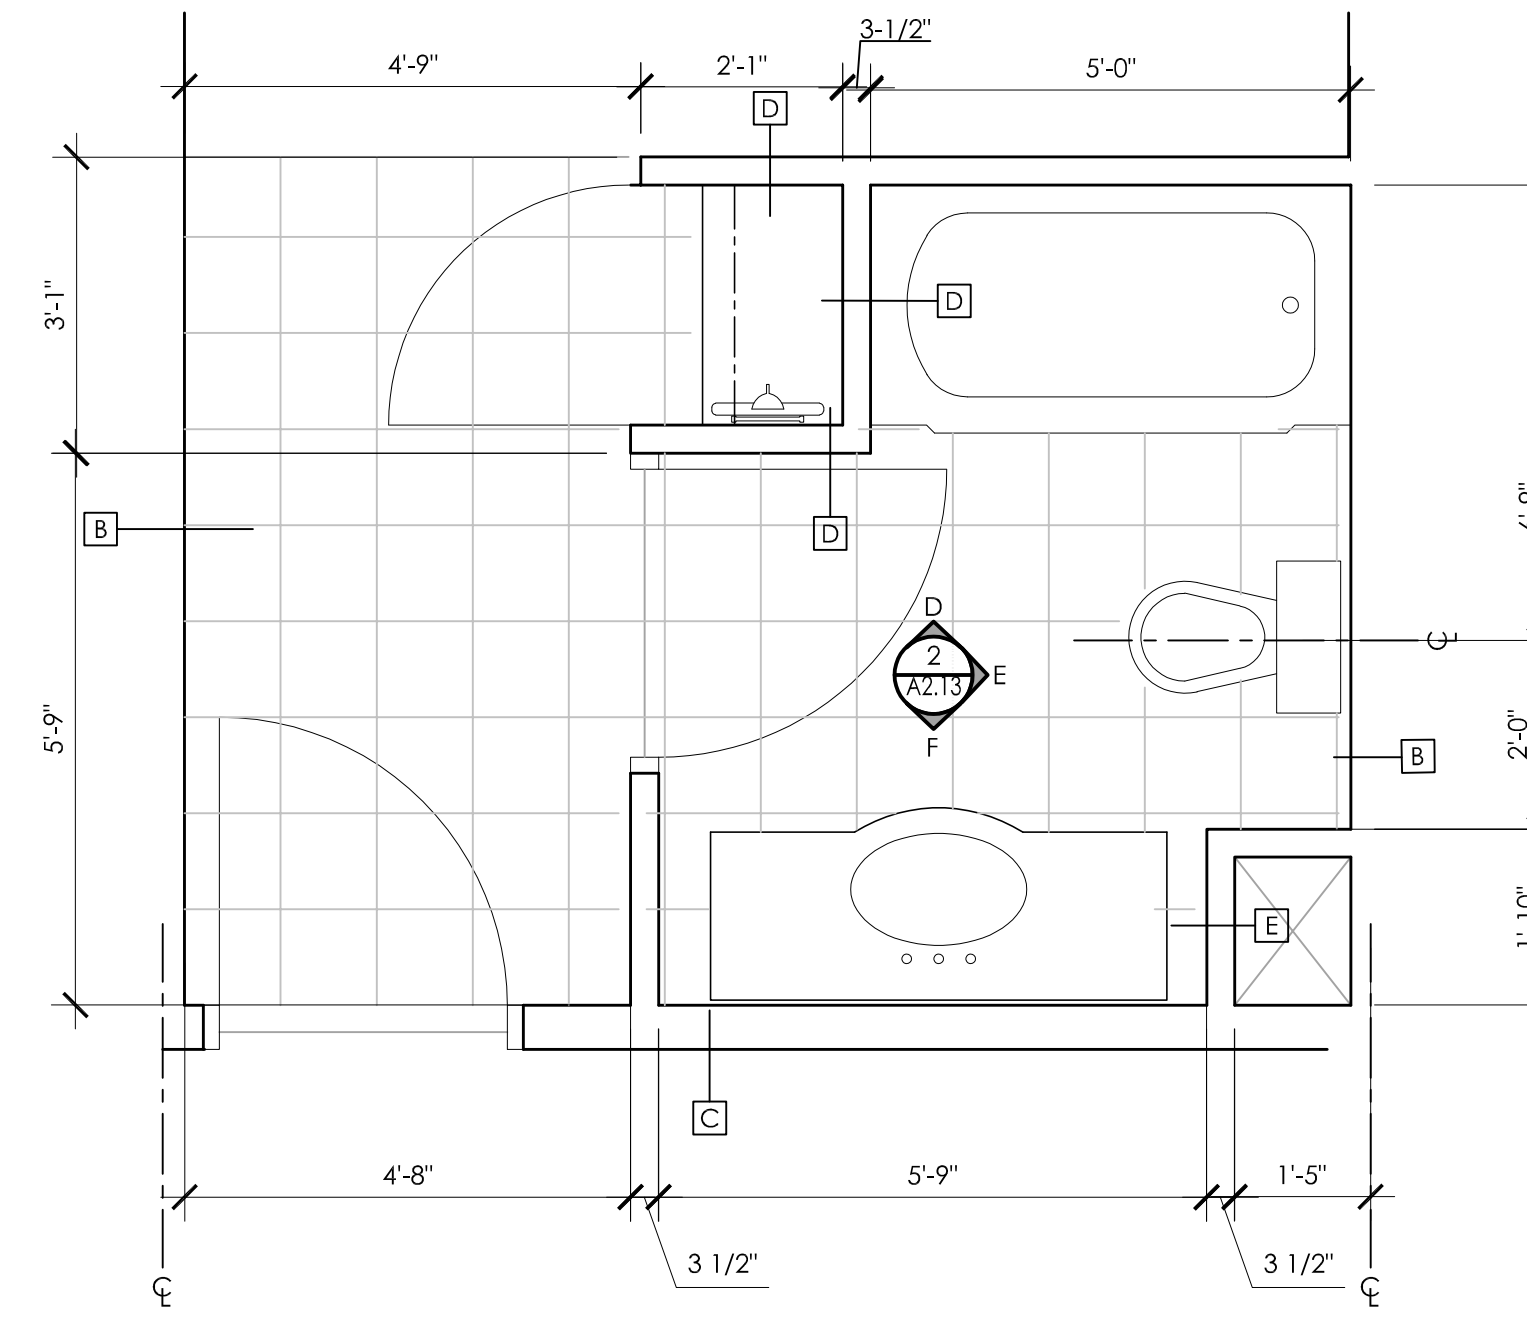

**2** TYPICAL DOUBLE QUEEN GUEST ROOM BATH PLAN  
 $24 \times 36 - 1/2" = 1'-0"$   
 $12 \times 18 - 1/4" = 1'-0"$

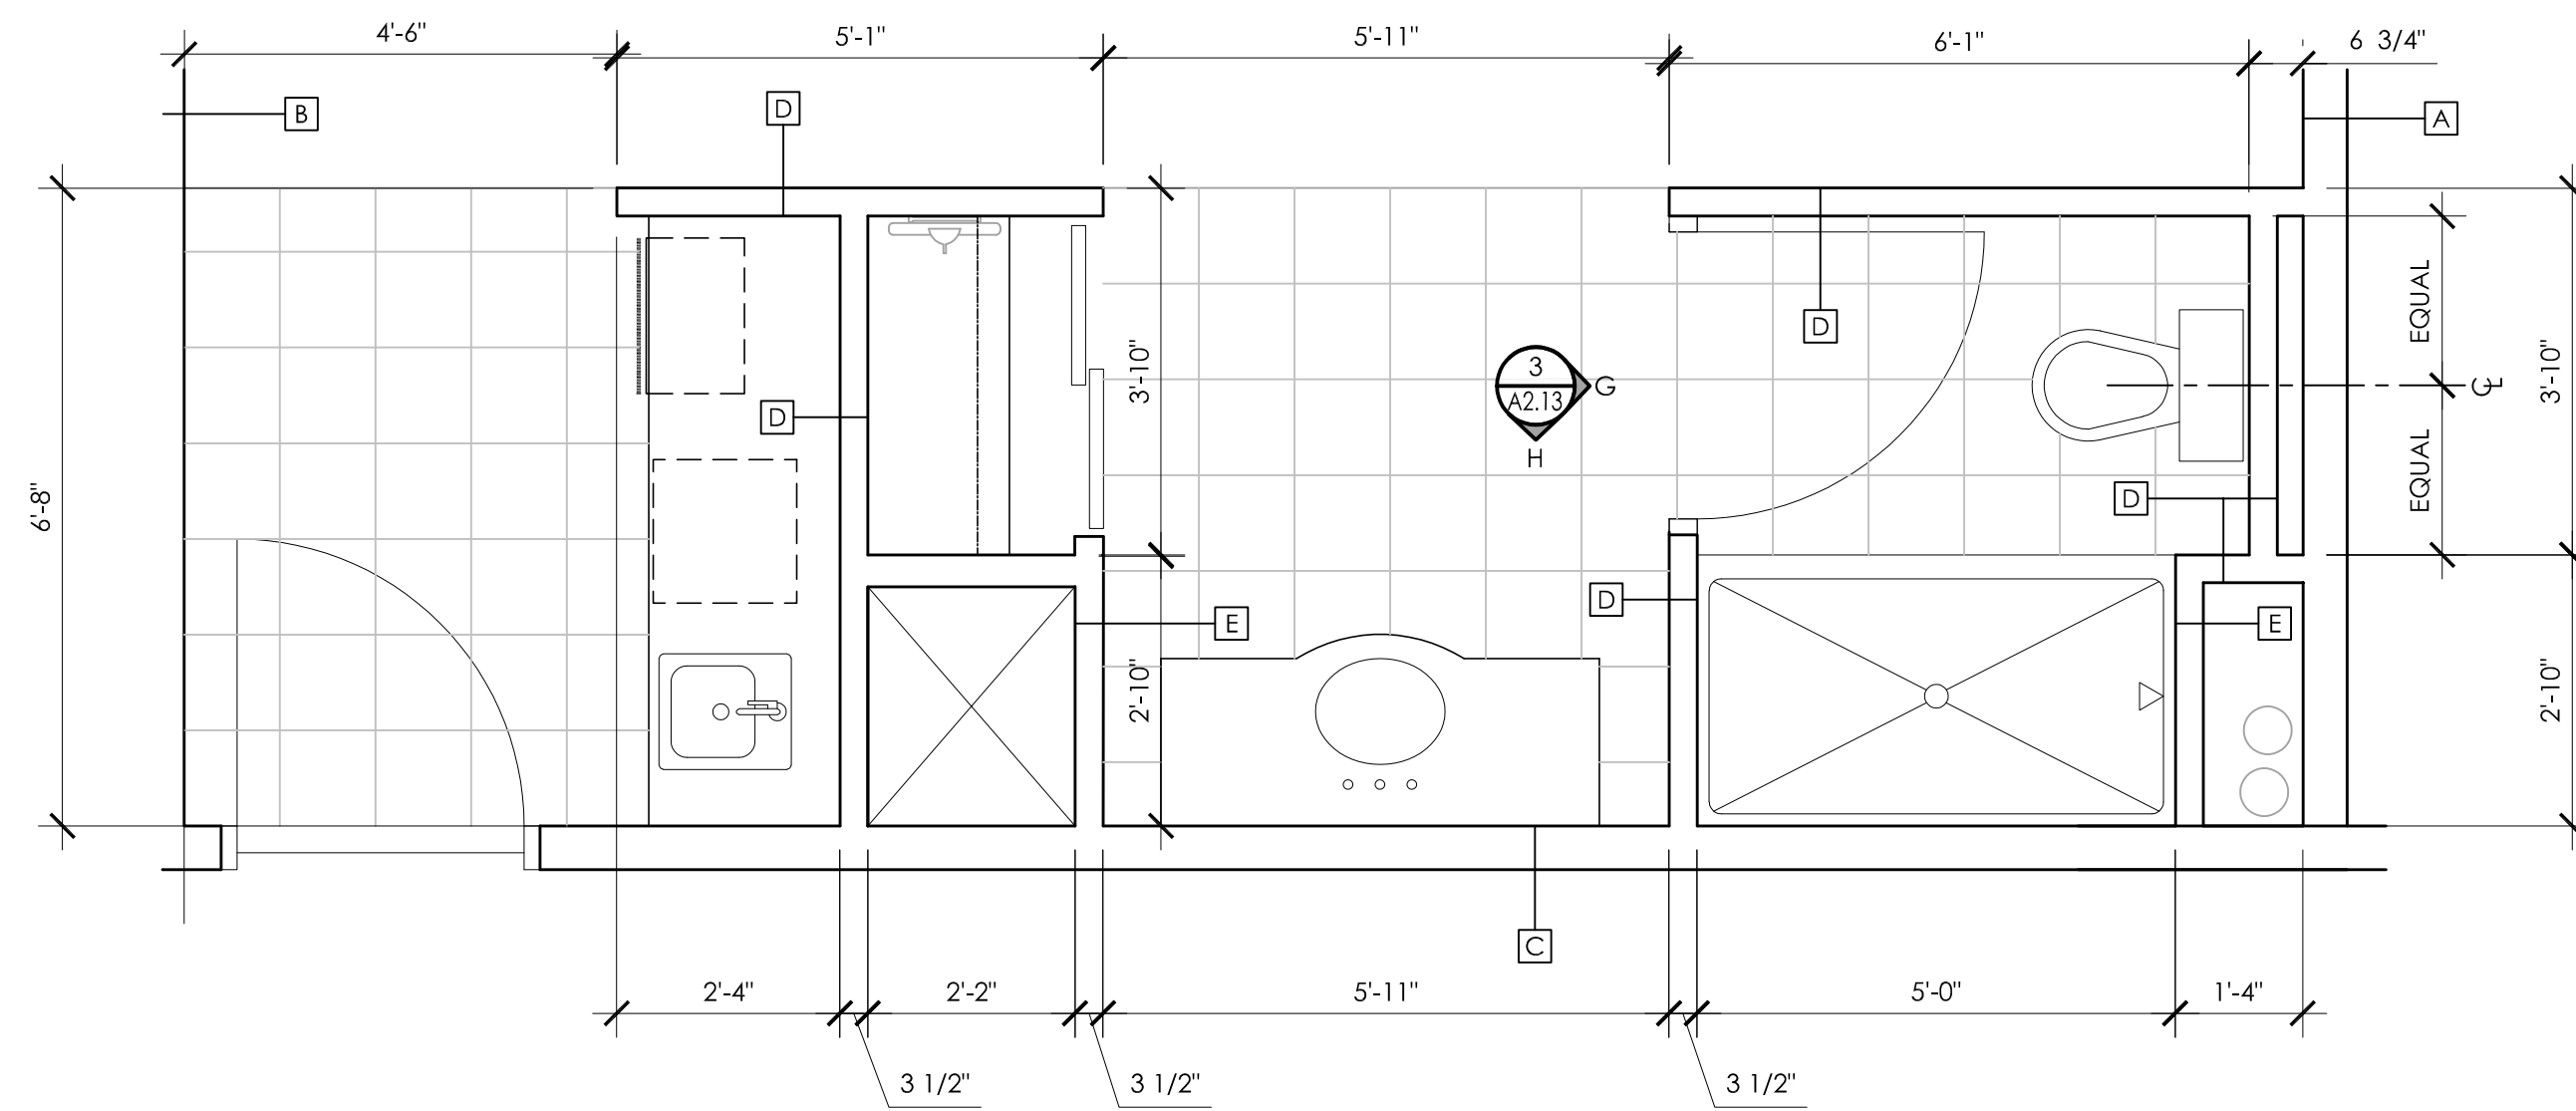

**3** KING STUDIO ROOM BATH PLAN  
 $24 \times 36 - 1/2" = 1'-0"$   
 $12 \times 18 - 1/4" = 1'-0"$

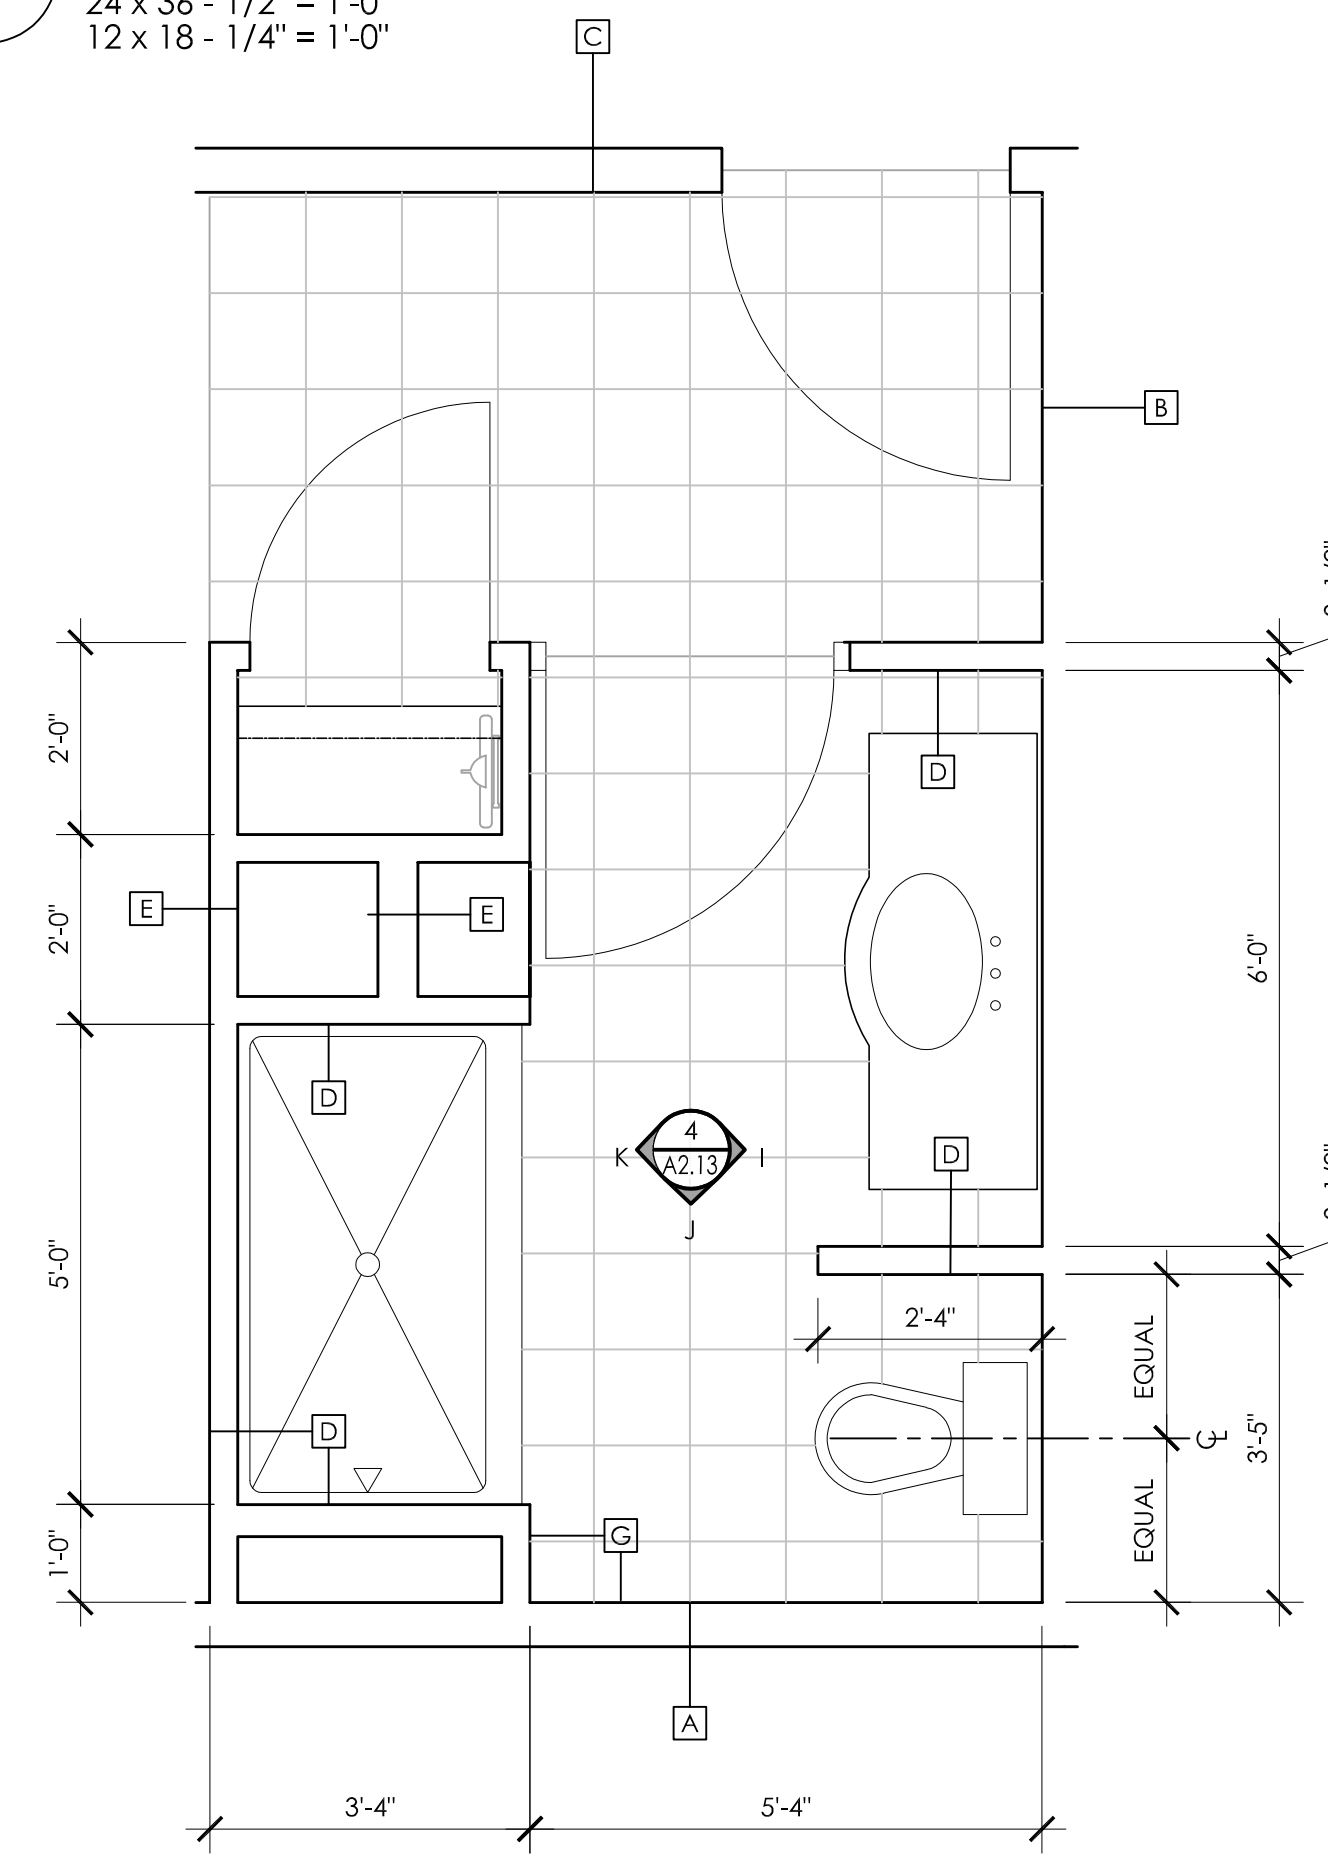

**4** KING ROOM BATH PLAN  
 $24 \times 36 - 1/2" = 1'-0"$   
 $12 \times 18 - 1/4" = 1'-0"$

GENERAL NOTES  
 1. DIMENSIONS ARE TO FACE OF STUDS UNLESS NOTED OTHERWISE.



12202 Pacific Ave. Suite C  
 Tacoma, Washington 98444  
 P: 253.531.4300 F: 253.537.6542  
 E: architects@austincina.com



**City of Puyallup**  
 Development & Permitting Services  
**ISSUED PERMIT**


Building	Planning
Engineering	Public Works
Fire	Traffic

ENLARGED BATHROOM PLANS

Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA


Job #:  
 Date: January 6, 2020  
 Revs:



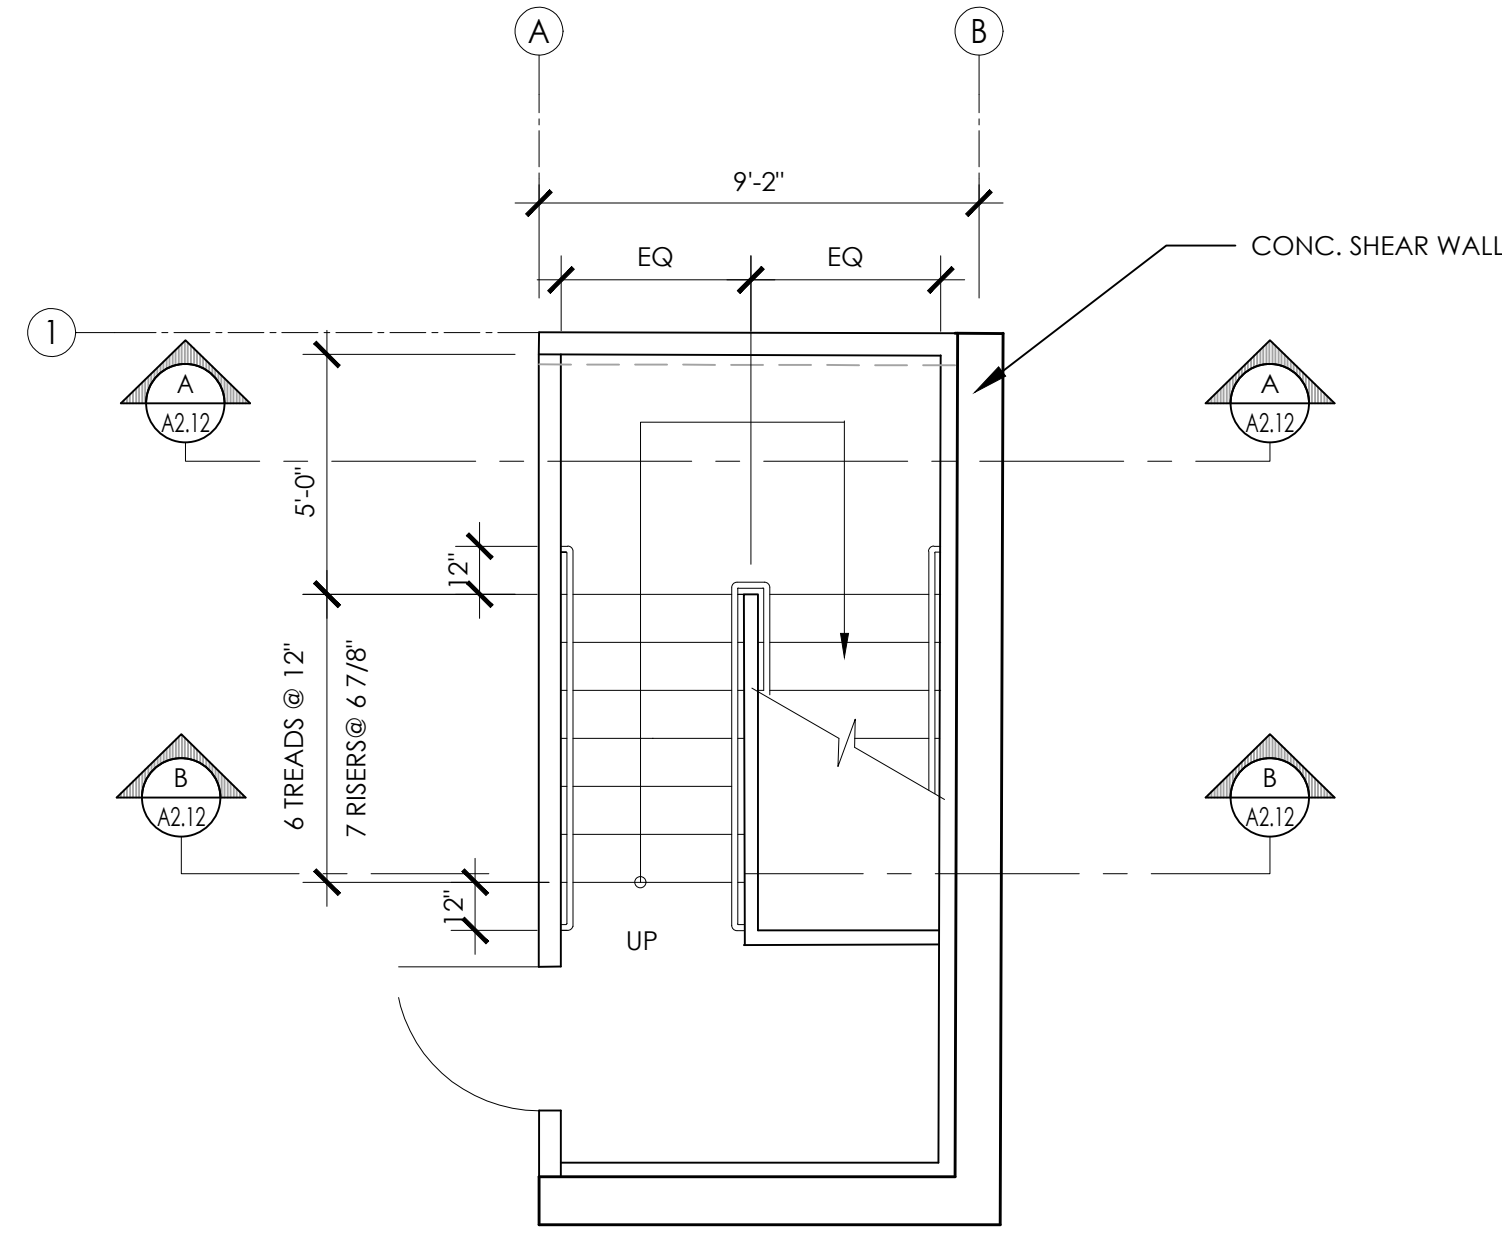


NOTE: FINISHED WIDTH OF EA STAIR RUN 44" MIN.

**1 ENLARGED STAIRS PLAN - FIRST FLOOR**  
 24 x 36 - 1/4" = 1'-0"  
 12 x 18 - 1/8" = 1'-0"

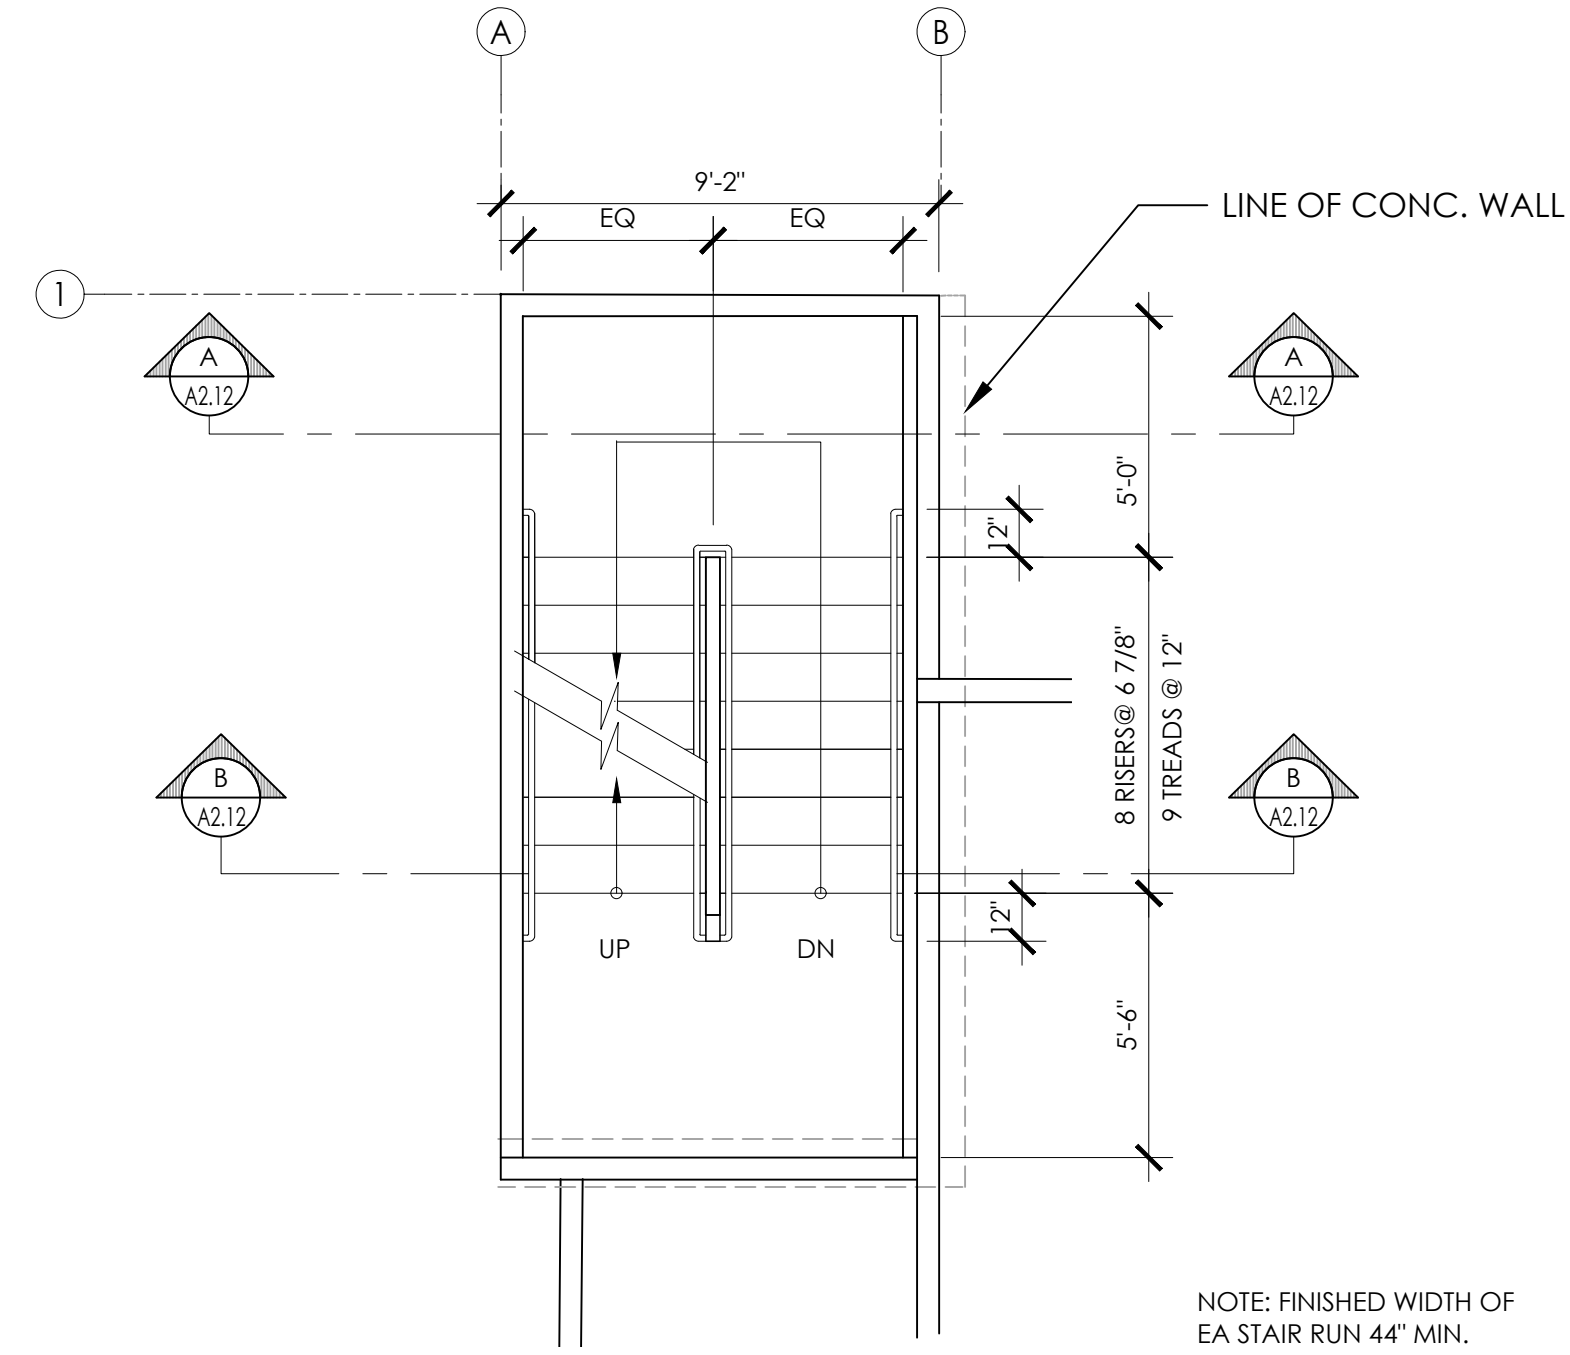

NOTE: FINISHED WIDTH OF EA STAIR RUN 44" MIN.

**2 ENLARGED STAIRS PLAN - 2ND, 3RD, & 4TH FLOOR**  
 24 x 36 - 1/4" = 1'-0"  
 12 x 18 - 1/8" = 1'-0"

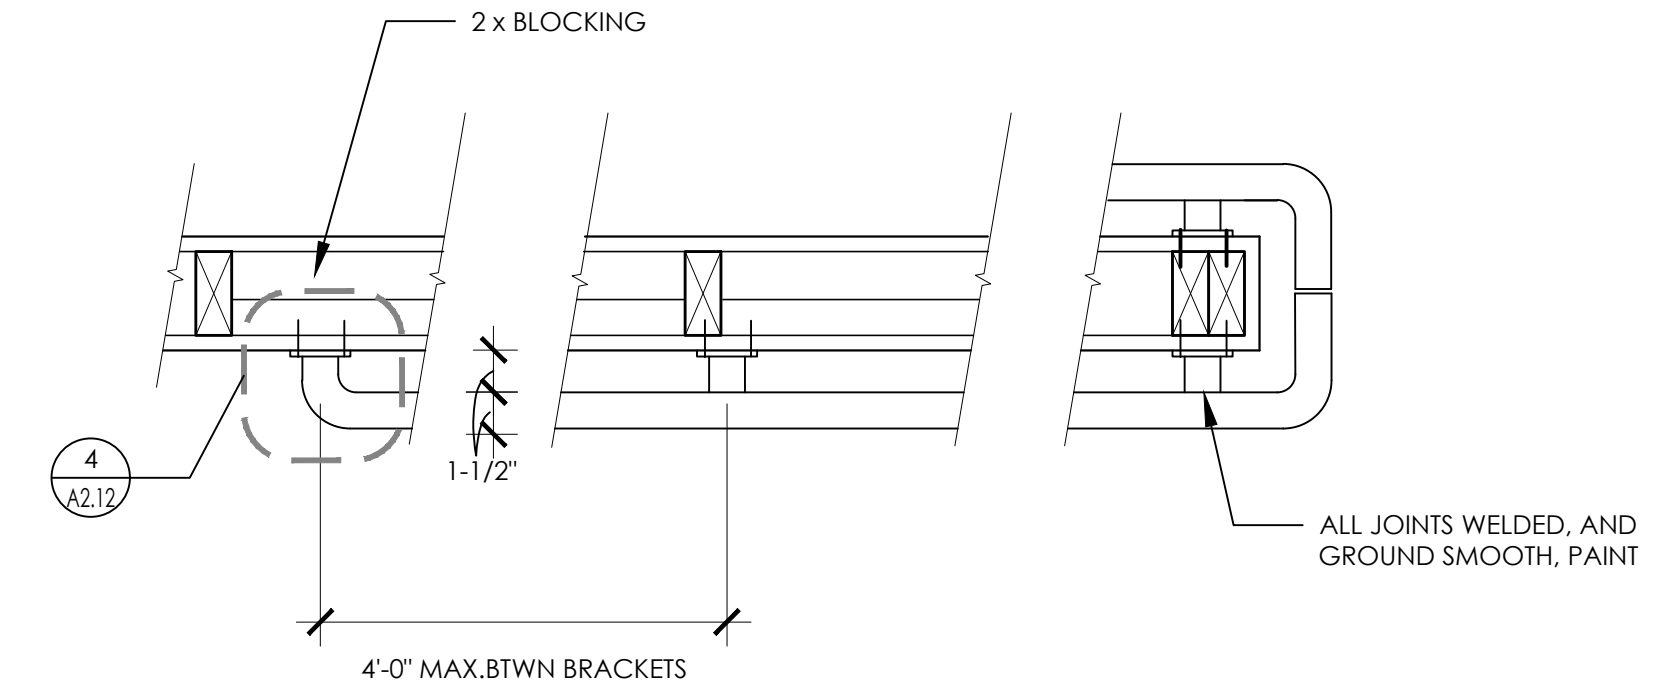

**3 HANDRAIL DETAIL**  
 24 X 36 - 1 1/2"=1'-0"  
 12 x 17 - 3/4"=1'-0"


**City of Puyallup**  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic


**AUSTINCINA**  
 architects p.s.

12202 Pacific Ave. Suite C  
 Tacoma, Washington 98444  
 P: 253.531.4300 F: 253.537.6542  
 E: architects@austincina.com


3072 REGISTERED ARCHITECT  
 MICHAEL J. AUSTINCINA  
 STATE OF WASHINGTON

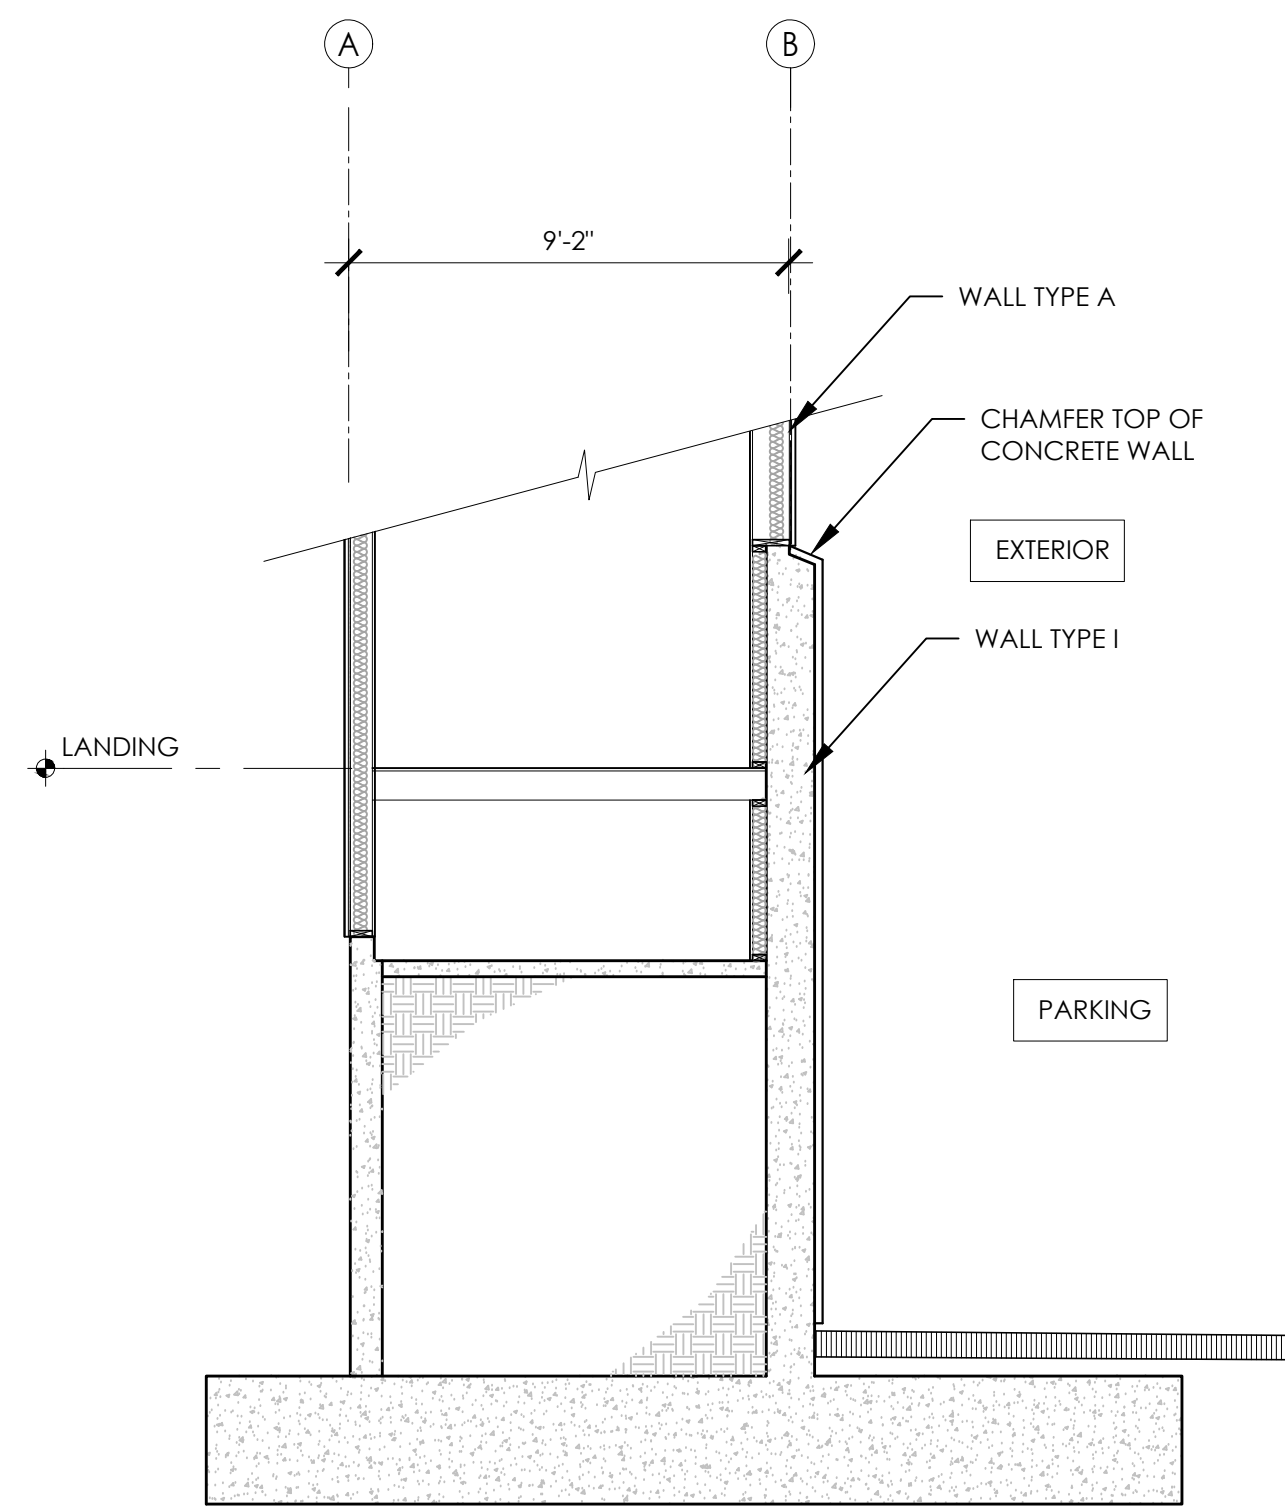

**A STAIR SECTION**  
 24 x 36 - 1/4" = 1'-0"  
 12 x 18 - 1/8" = 1'-0"

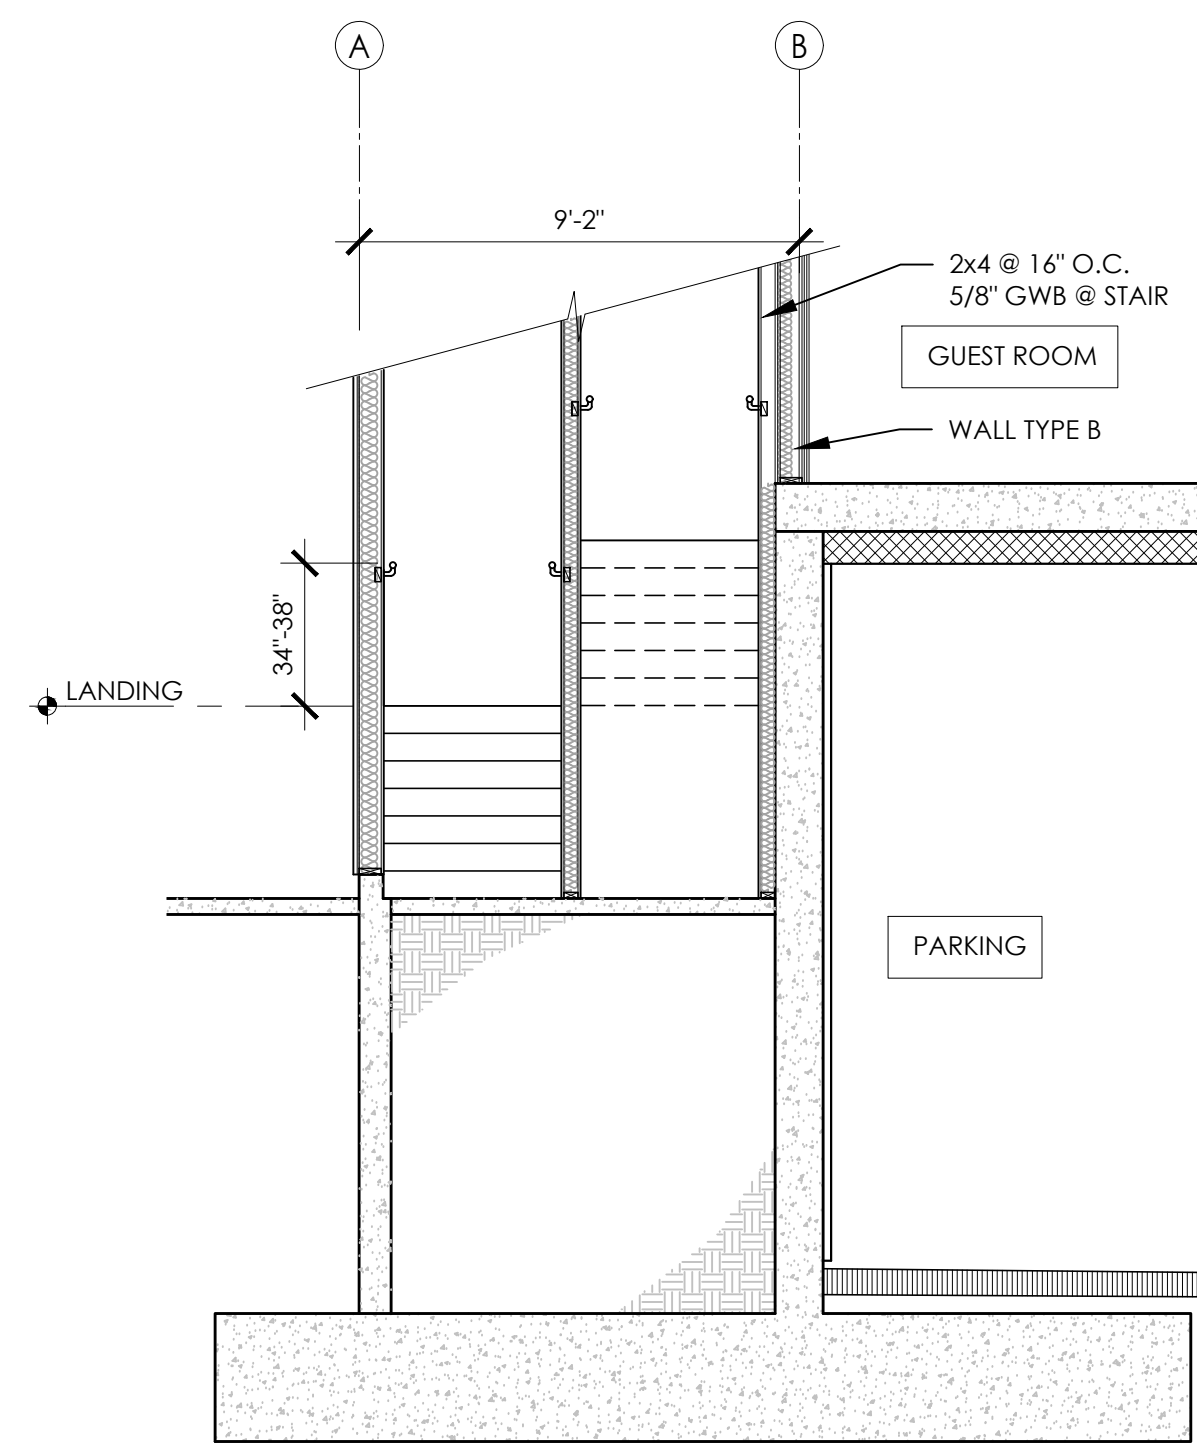

**B STAIR SECTION**  
 24 x 36 - 1/4" = 1'-0"  
 12 x 18 - 1/8" = 1'-0"

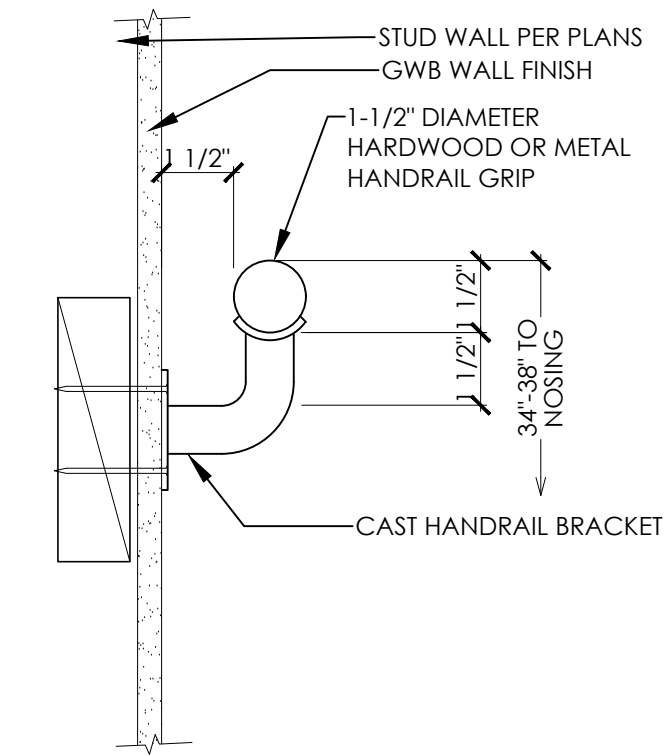


**4 HANDRAIL DETAIL SECTION**  
 24 X 36 - 3"=1'-0"  
 12 x 17 - 1 1/2"=1'-0"


ENLARGED STAIR PLANS

Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA


Job #:  
 Date: January 6, 2020  
 Revs:

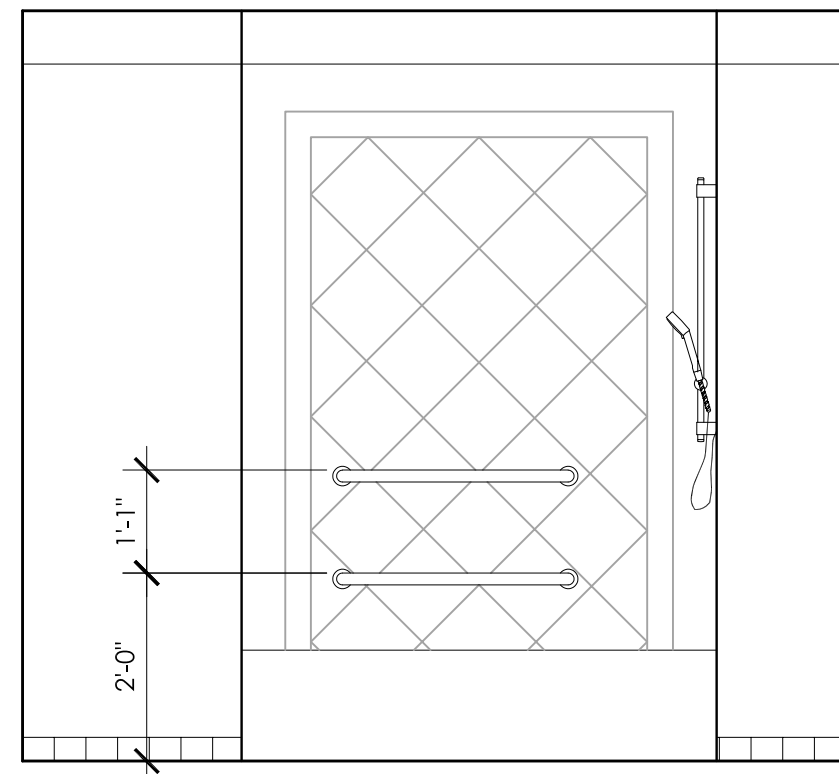

A

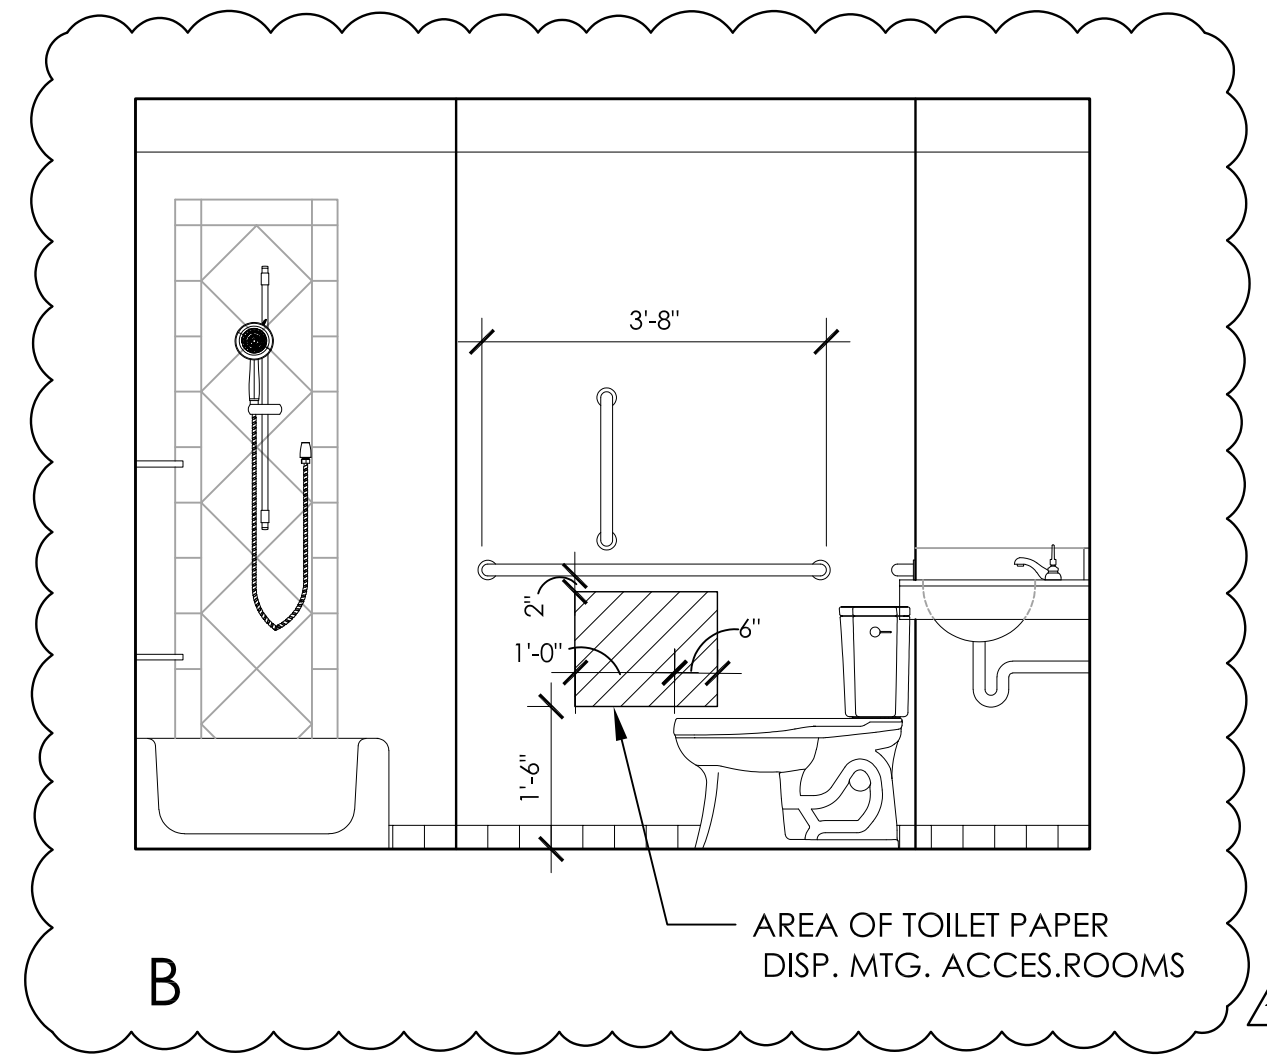

B

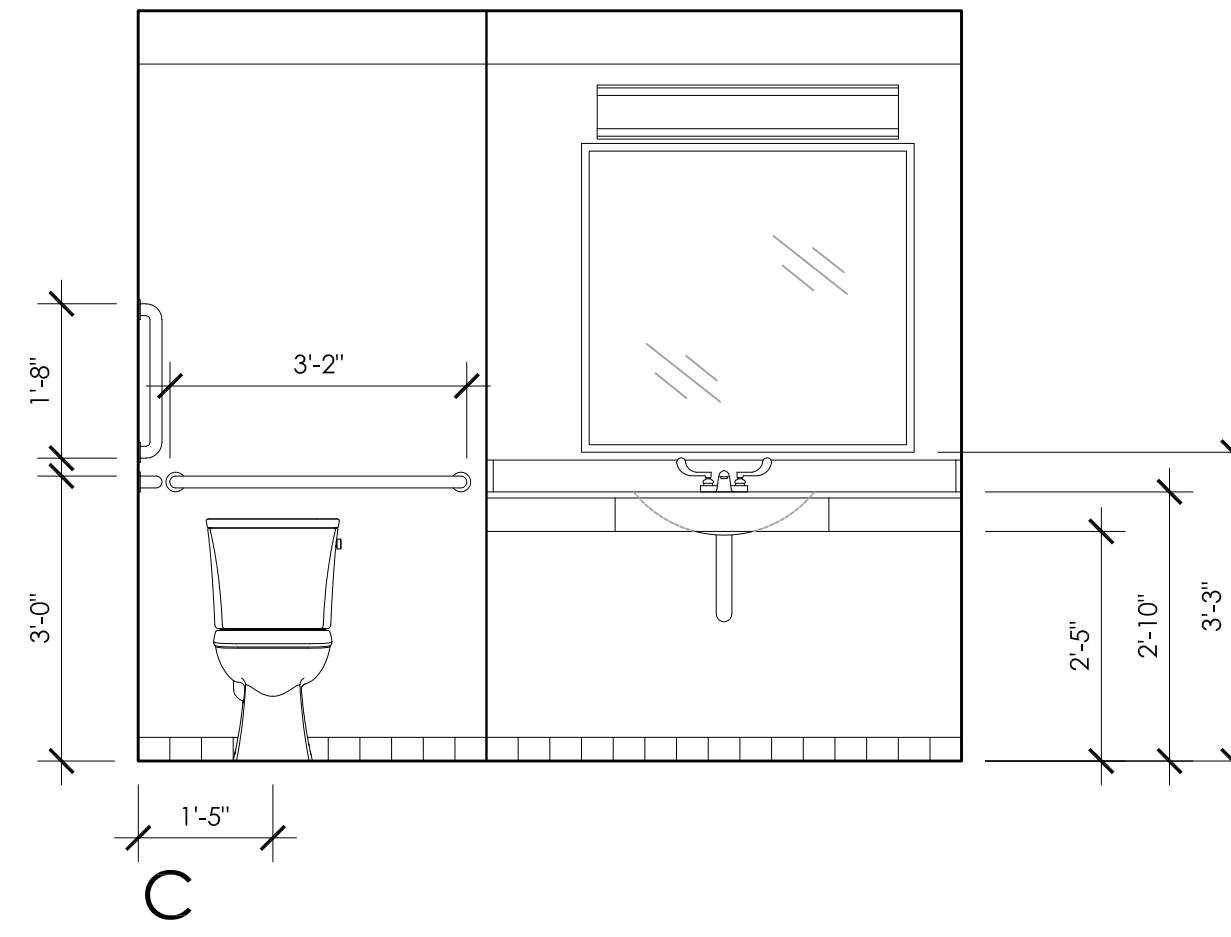


C

**GENERAL NOTES:**

1. PROVIDE BLOCKING AT ALL WALL MOUNTED ACCESSORIES.




12202 Pacific Ave. Suite C  
Tacoma, Washington 98444  
P: 253.531.4300 F: 253.537.6542  
E: architects@austincina.com

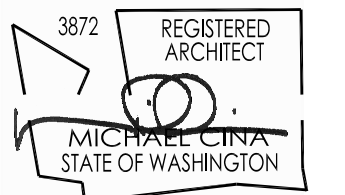


RESPONSE TO BUILDING REV.  
COMMENT 03/10/20

**1 ELEVATIONS @ ACCESSIBLE DOUBLE QUEEN ROOM**


24 x 36 - 1/2" = 1'-0"  
12 x 18 - 1/4" = 1'-0"

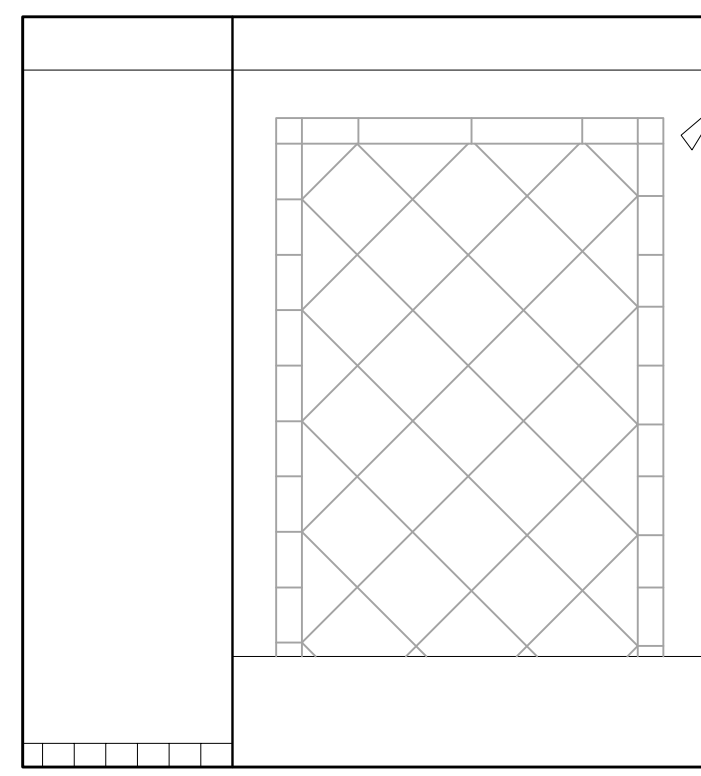


D

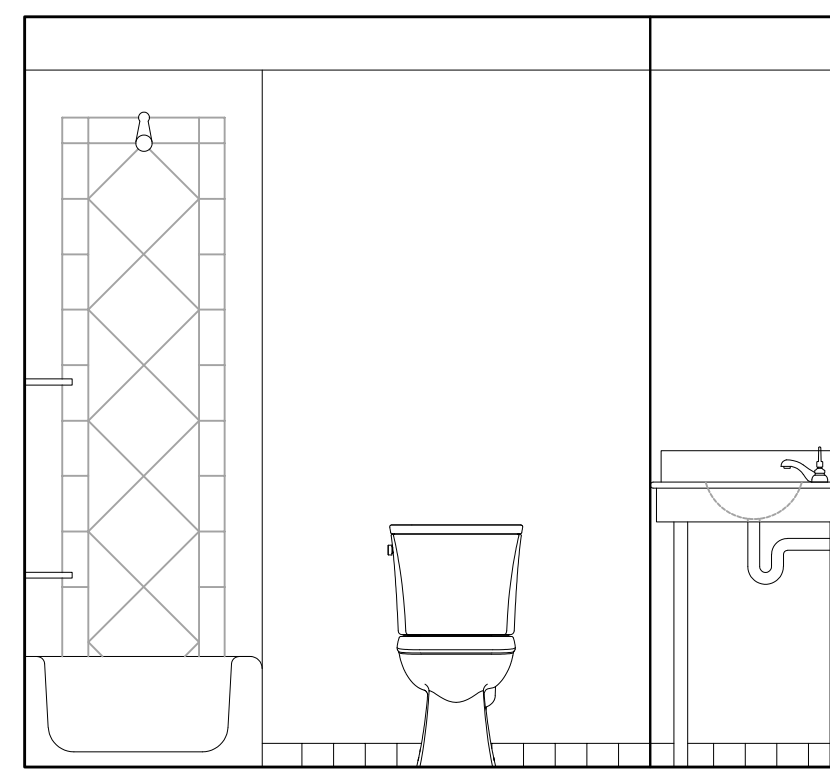

E

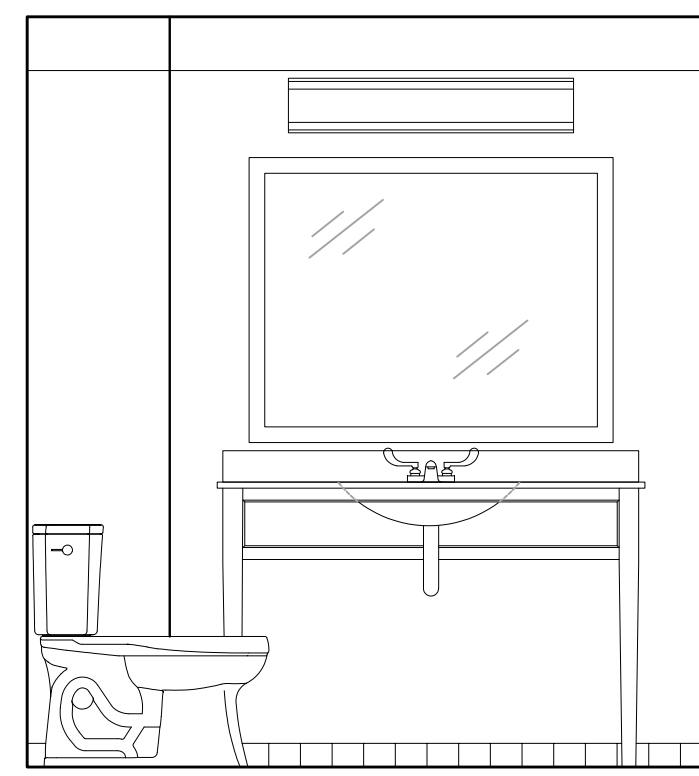


F

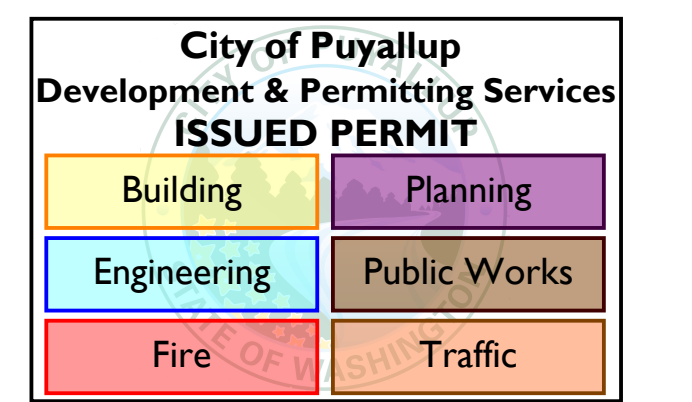


**2 ELEVATIONS @ DOUBLE QUEEN ROOM**


24 x 36 - 1/2" = 1'-0"  
12 x 18 - 1/4" = 1'-0"

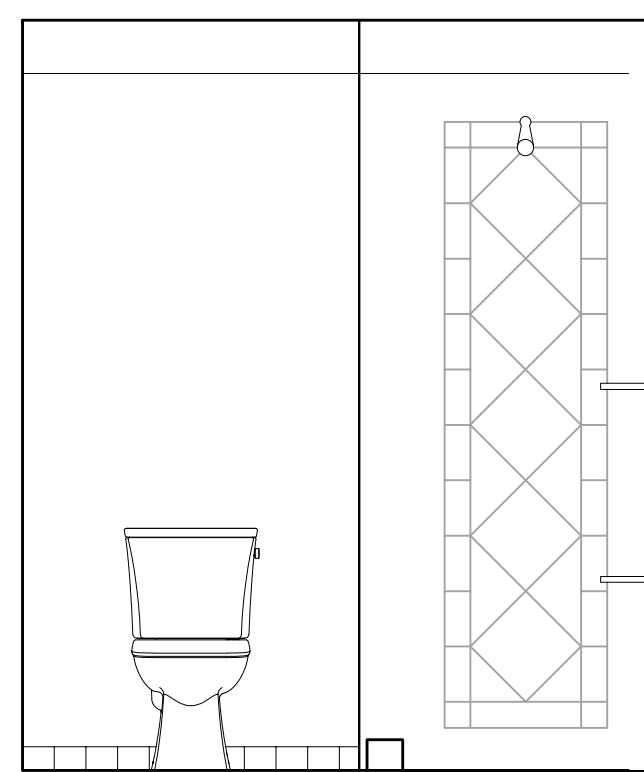


G

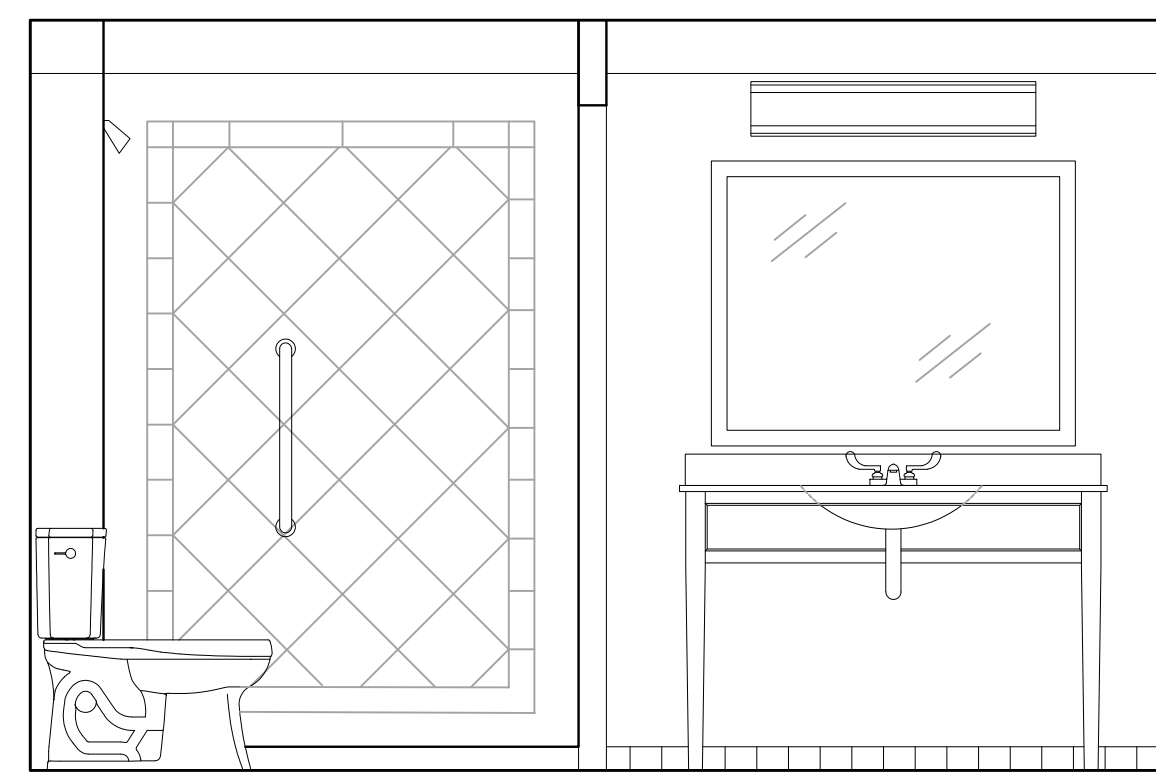


H

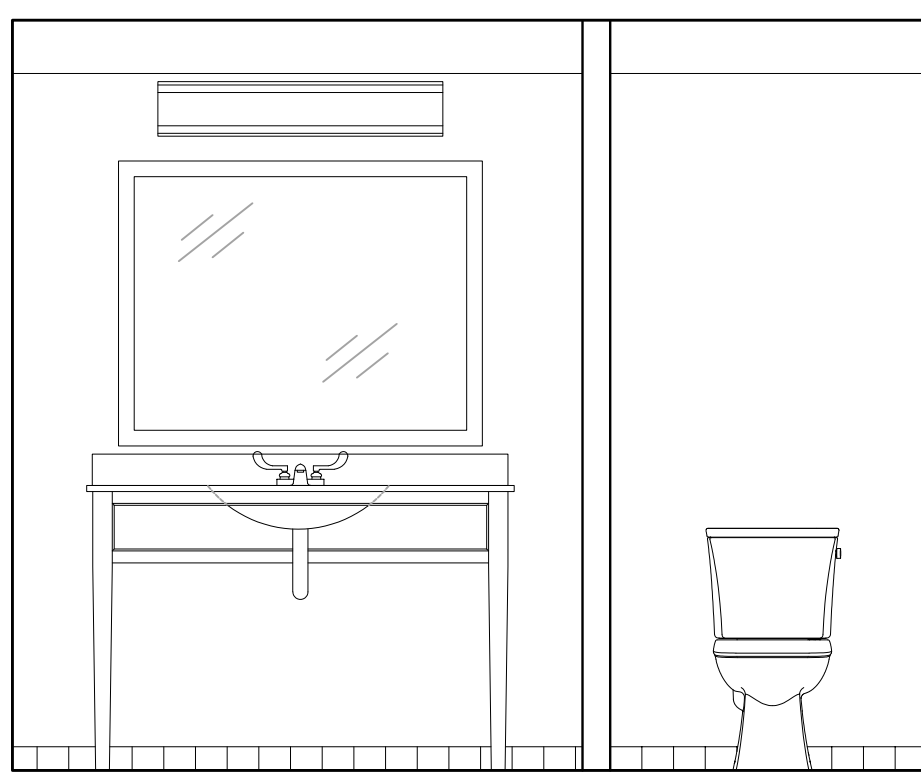

I

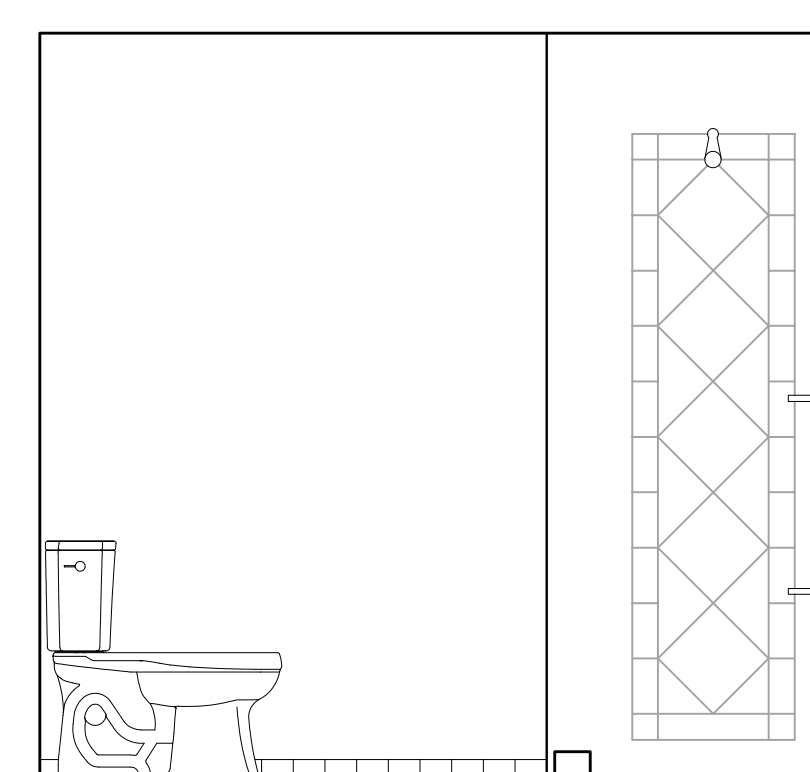

J

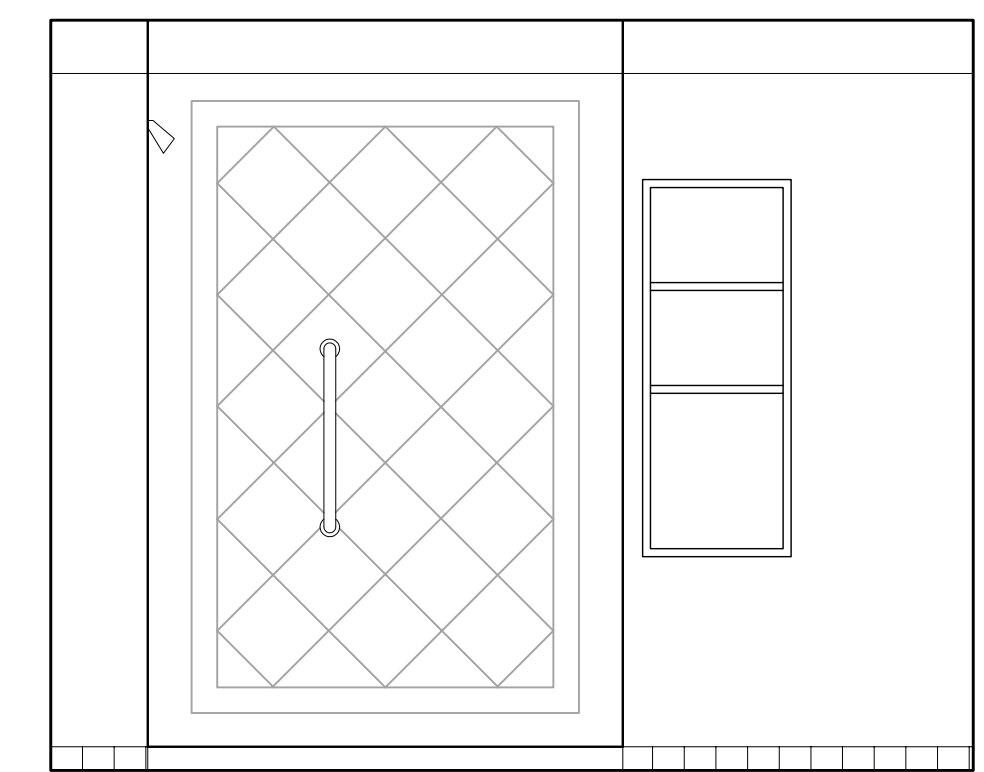

K

**3 ELEVATIONS @ KING STUDIO**

24 x 36 - 1/2" = 1'-0"  
12 x 18 - 1/4" = 1'-0"


**4 ELEVATIONS @ KING ROOM**

24 x 36 - 1/2" = 1'-0"  
12 x 18 - 1/4" = 1'-0"

BATHROOM ELEVATIONS

Addition to Hampton Inn & Suites  
Hampton Inn & Suites  
1515 S. Meridian, Puyallup, WA

Job #:  
Date: January 6, 2020  
Revs: March 10, 2020




AUSTINCINA  
architects p.s.

12202 Pacific Ave. Suite C  
Tacoma, Washington 98444  
P: 253.531.4300 F: 253.537.6542  
E: architects@austincina.com




City of Puyallup  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

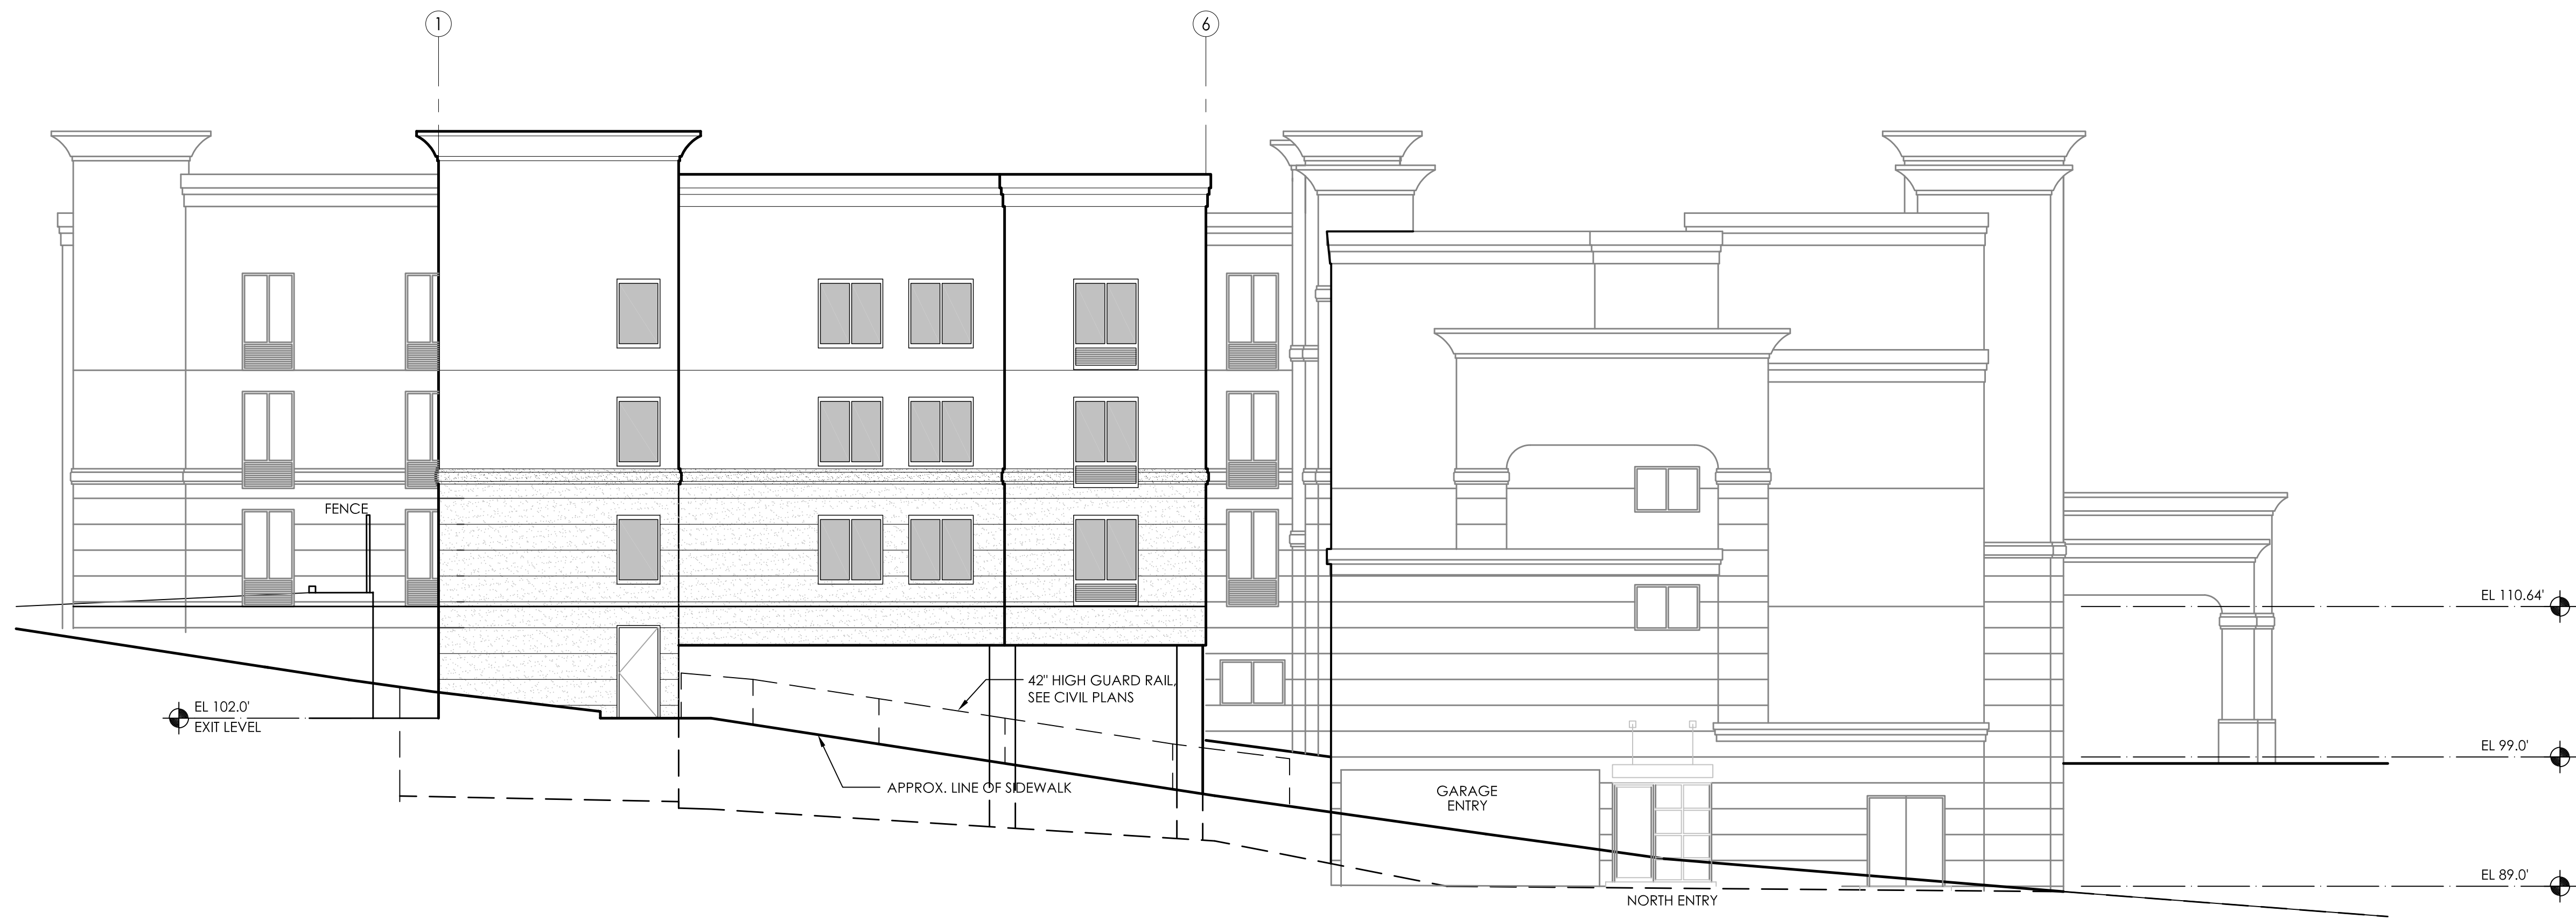


**1 NORTH ELEVATION**  
24 x 36 - 1/8" = 1'-0"  
12 x 18 - 1/16" = 1'-0"

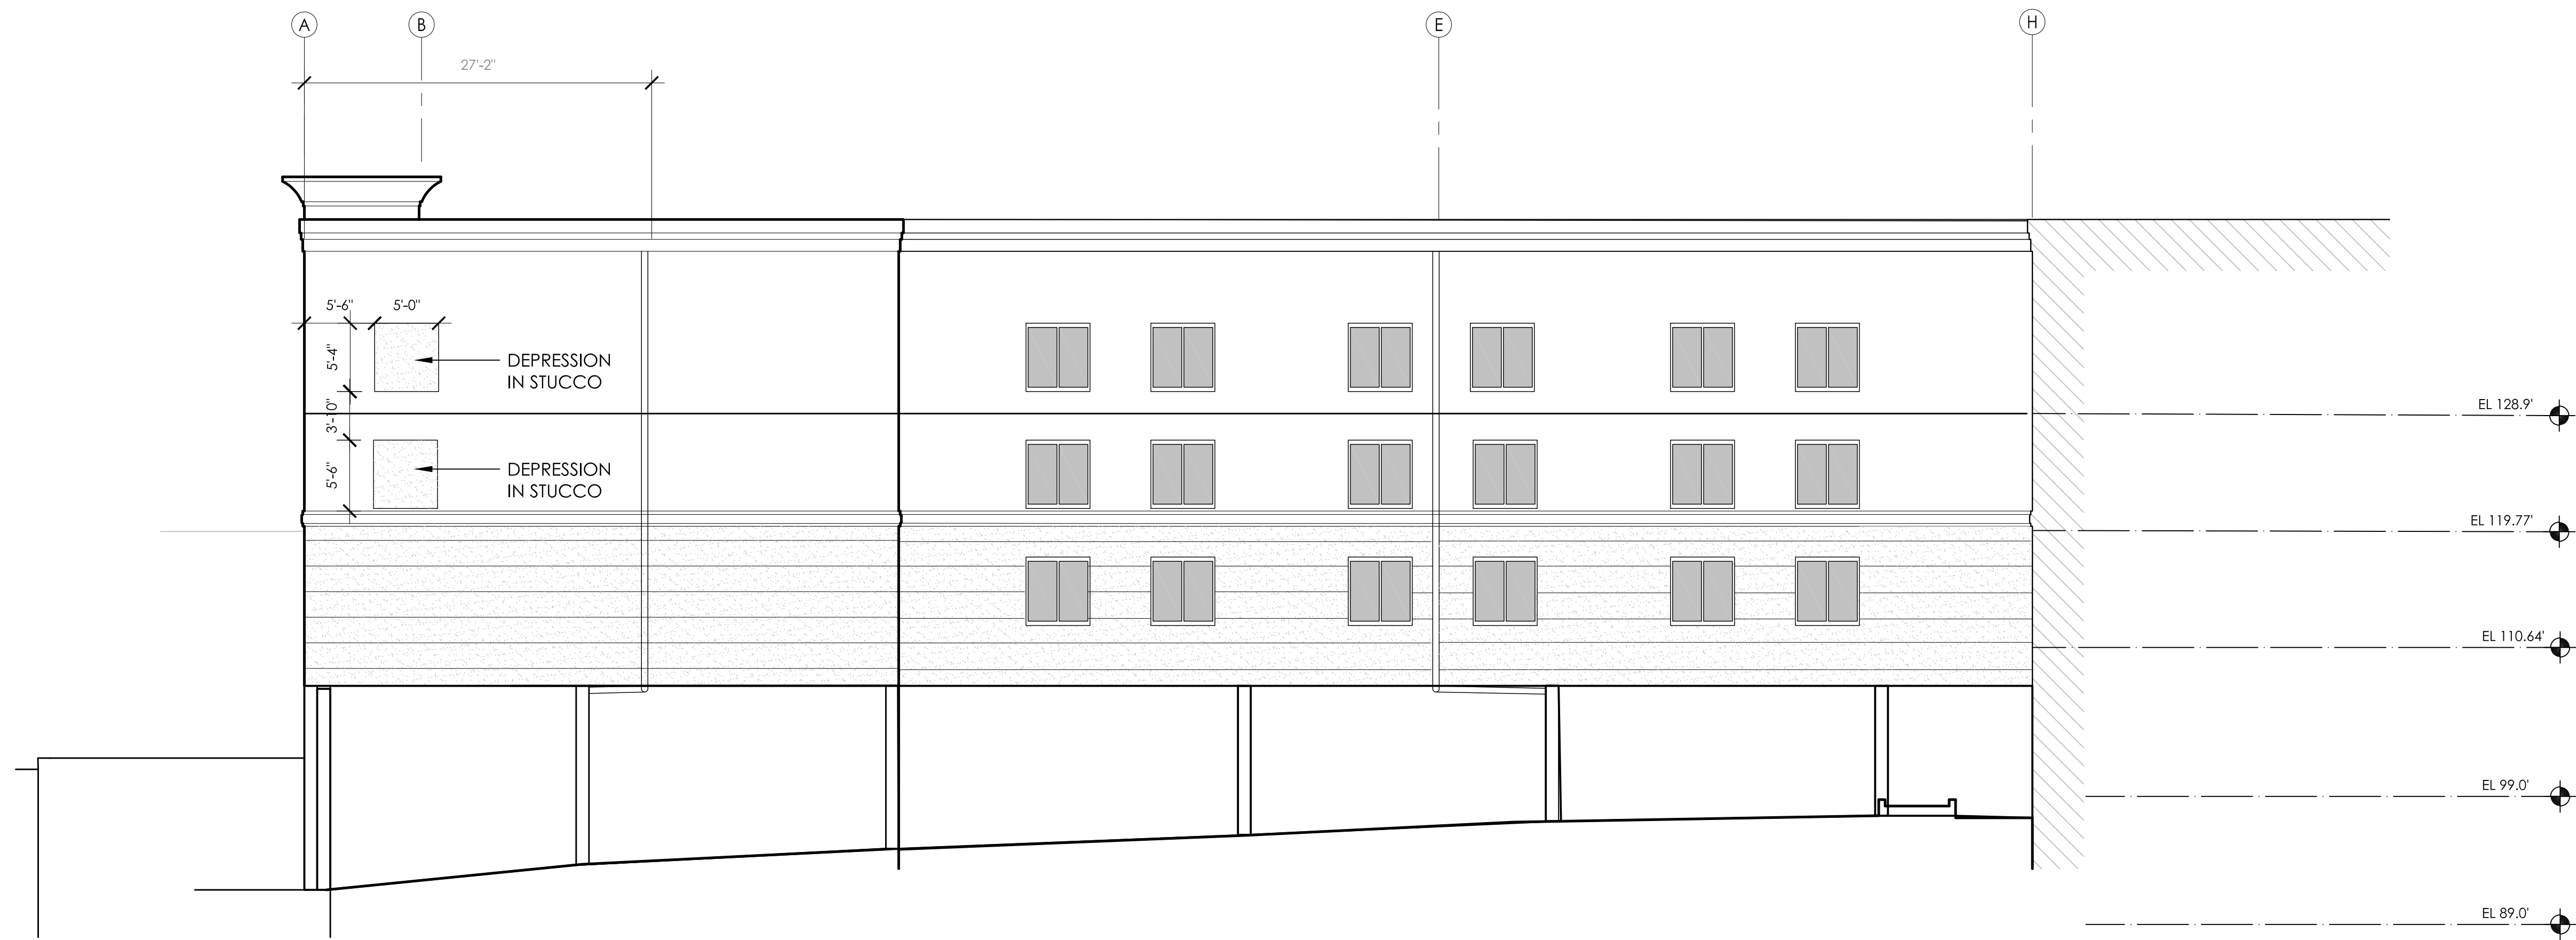


**2 WEST ELEVATION**  
24 x 36 - 1/8" = 1'-0"  
12 x 18 - 1/16" = 1'-0"

Addition to Hampton Inn & Suites  
Hampton Inn & Suites  
1515 S. Meridian, Puyallup, WA

Job #:  
Date: January 6, 2020  
Revs:

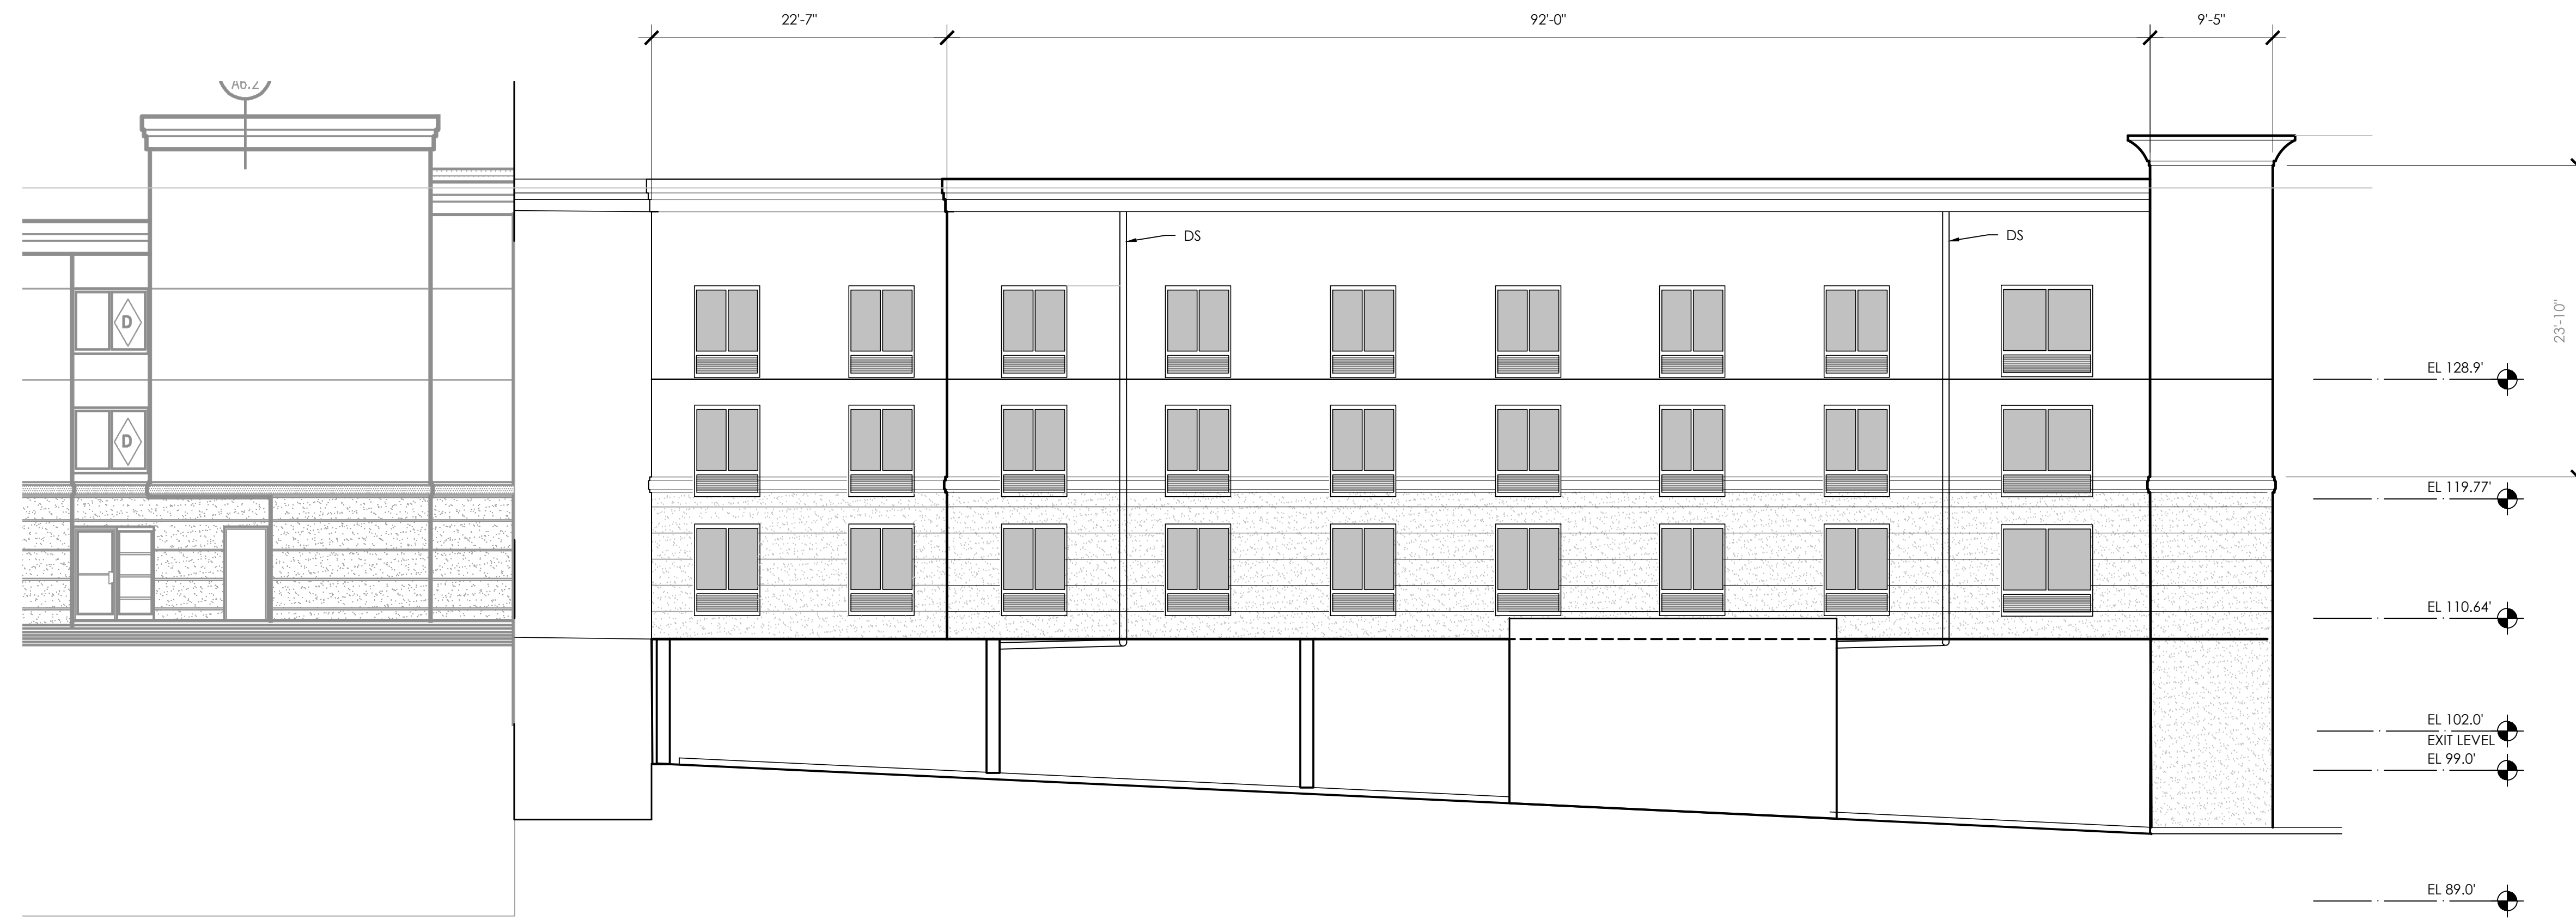

1 EAST ELEVATION  
 24 x 36 - 1/8" = 1'-0"  
 12 x 18 - 1/16" = 1'-0"

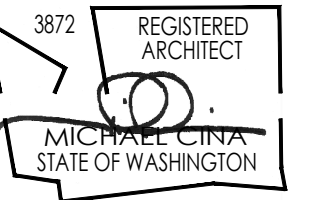

**City of Puyallup**  
 Development & Permitting Services  
**ISSUED PERMIT**


Building	Planning
Engineering	Public Works
Fire	Traffic

Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA

Job #:  
 Date: January 6, 2020  
 Revs:


**City of Puyallup**  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

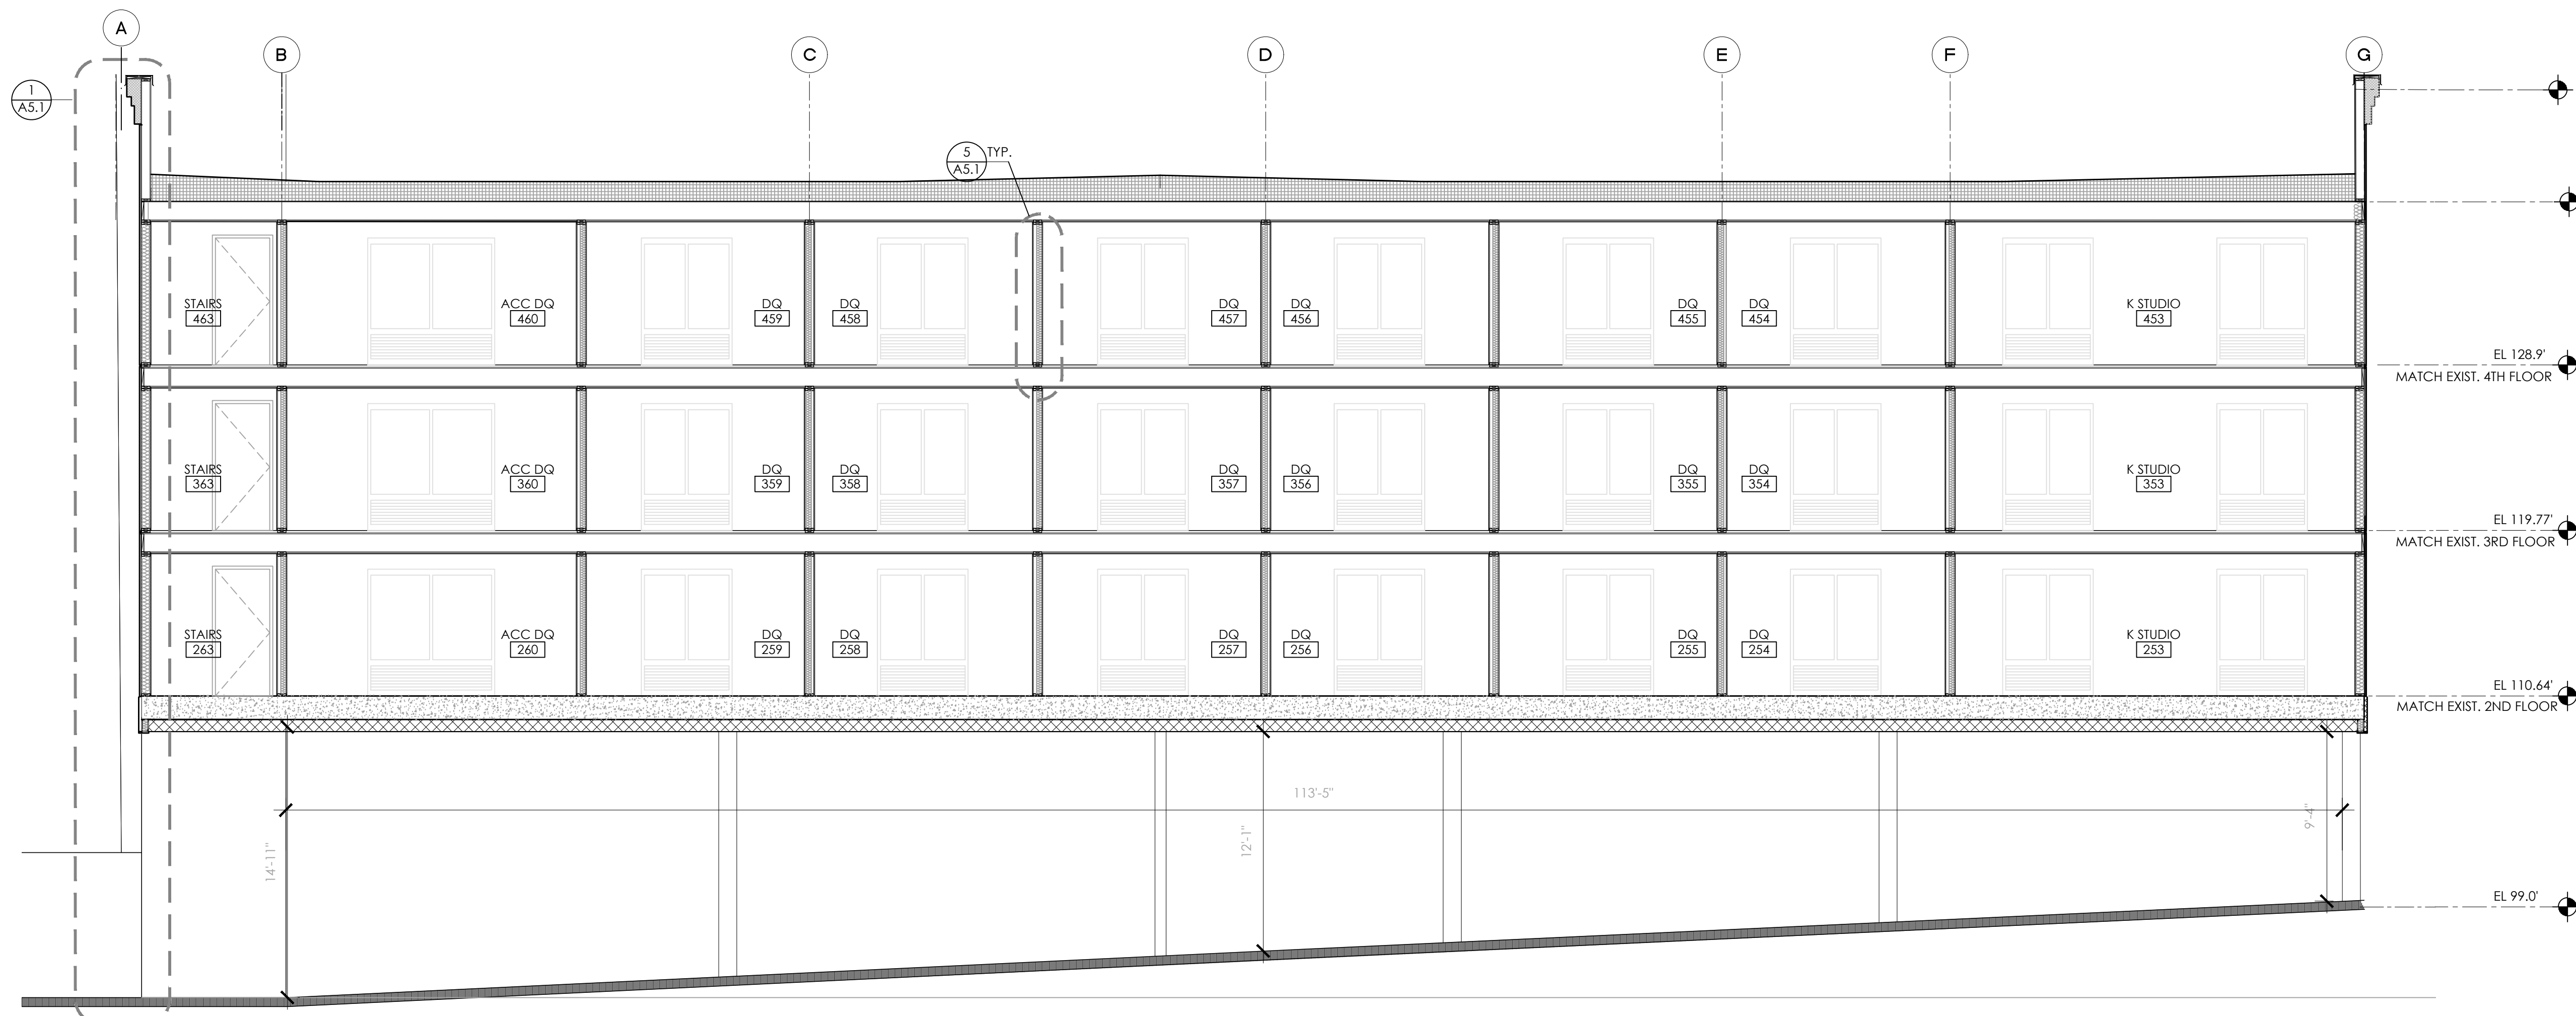


**1 BUILDING SECTION**

24 x 36 - 3/16" = 1'-0"  
12 x 18 - 3/32" = 1'-0"

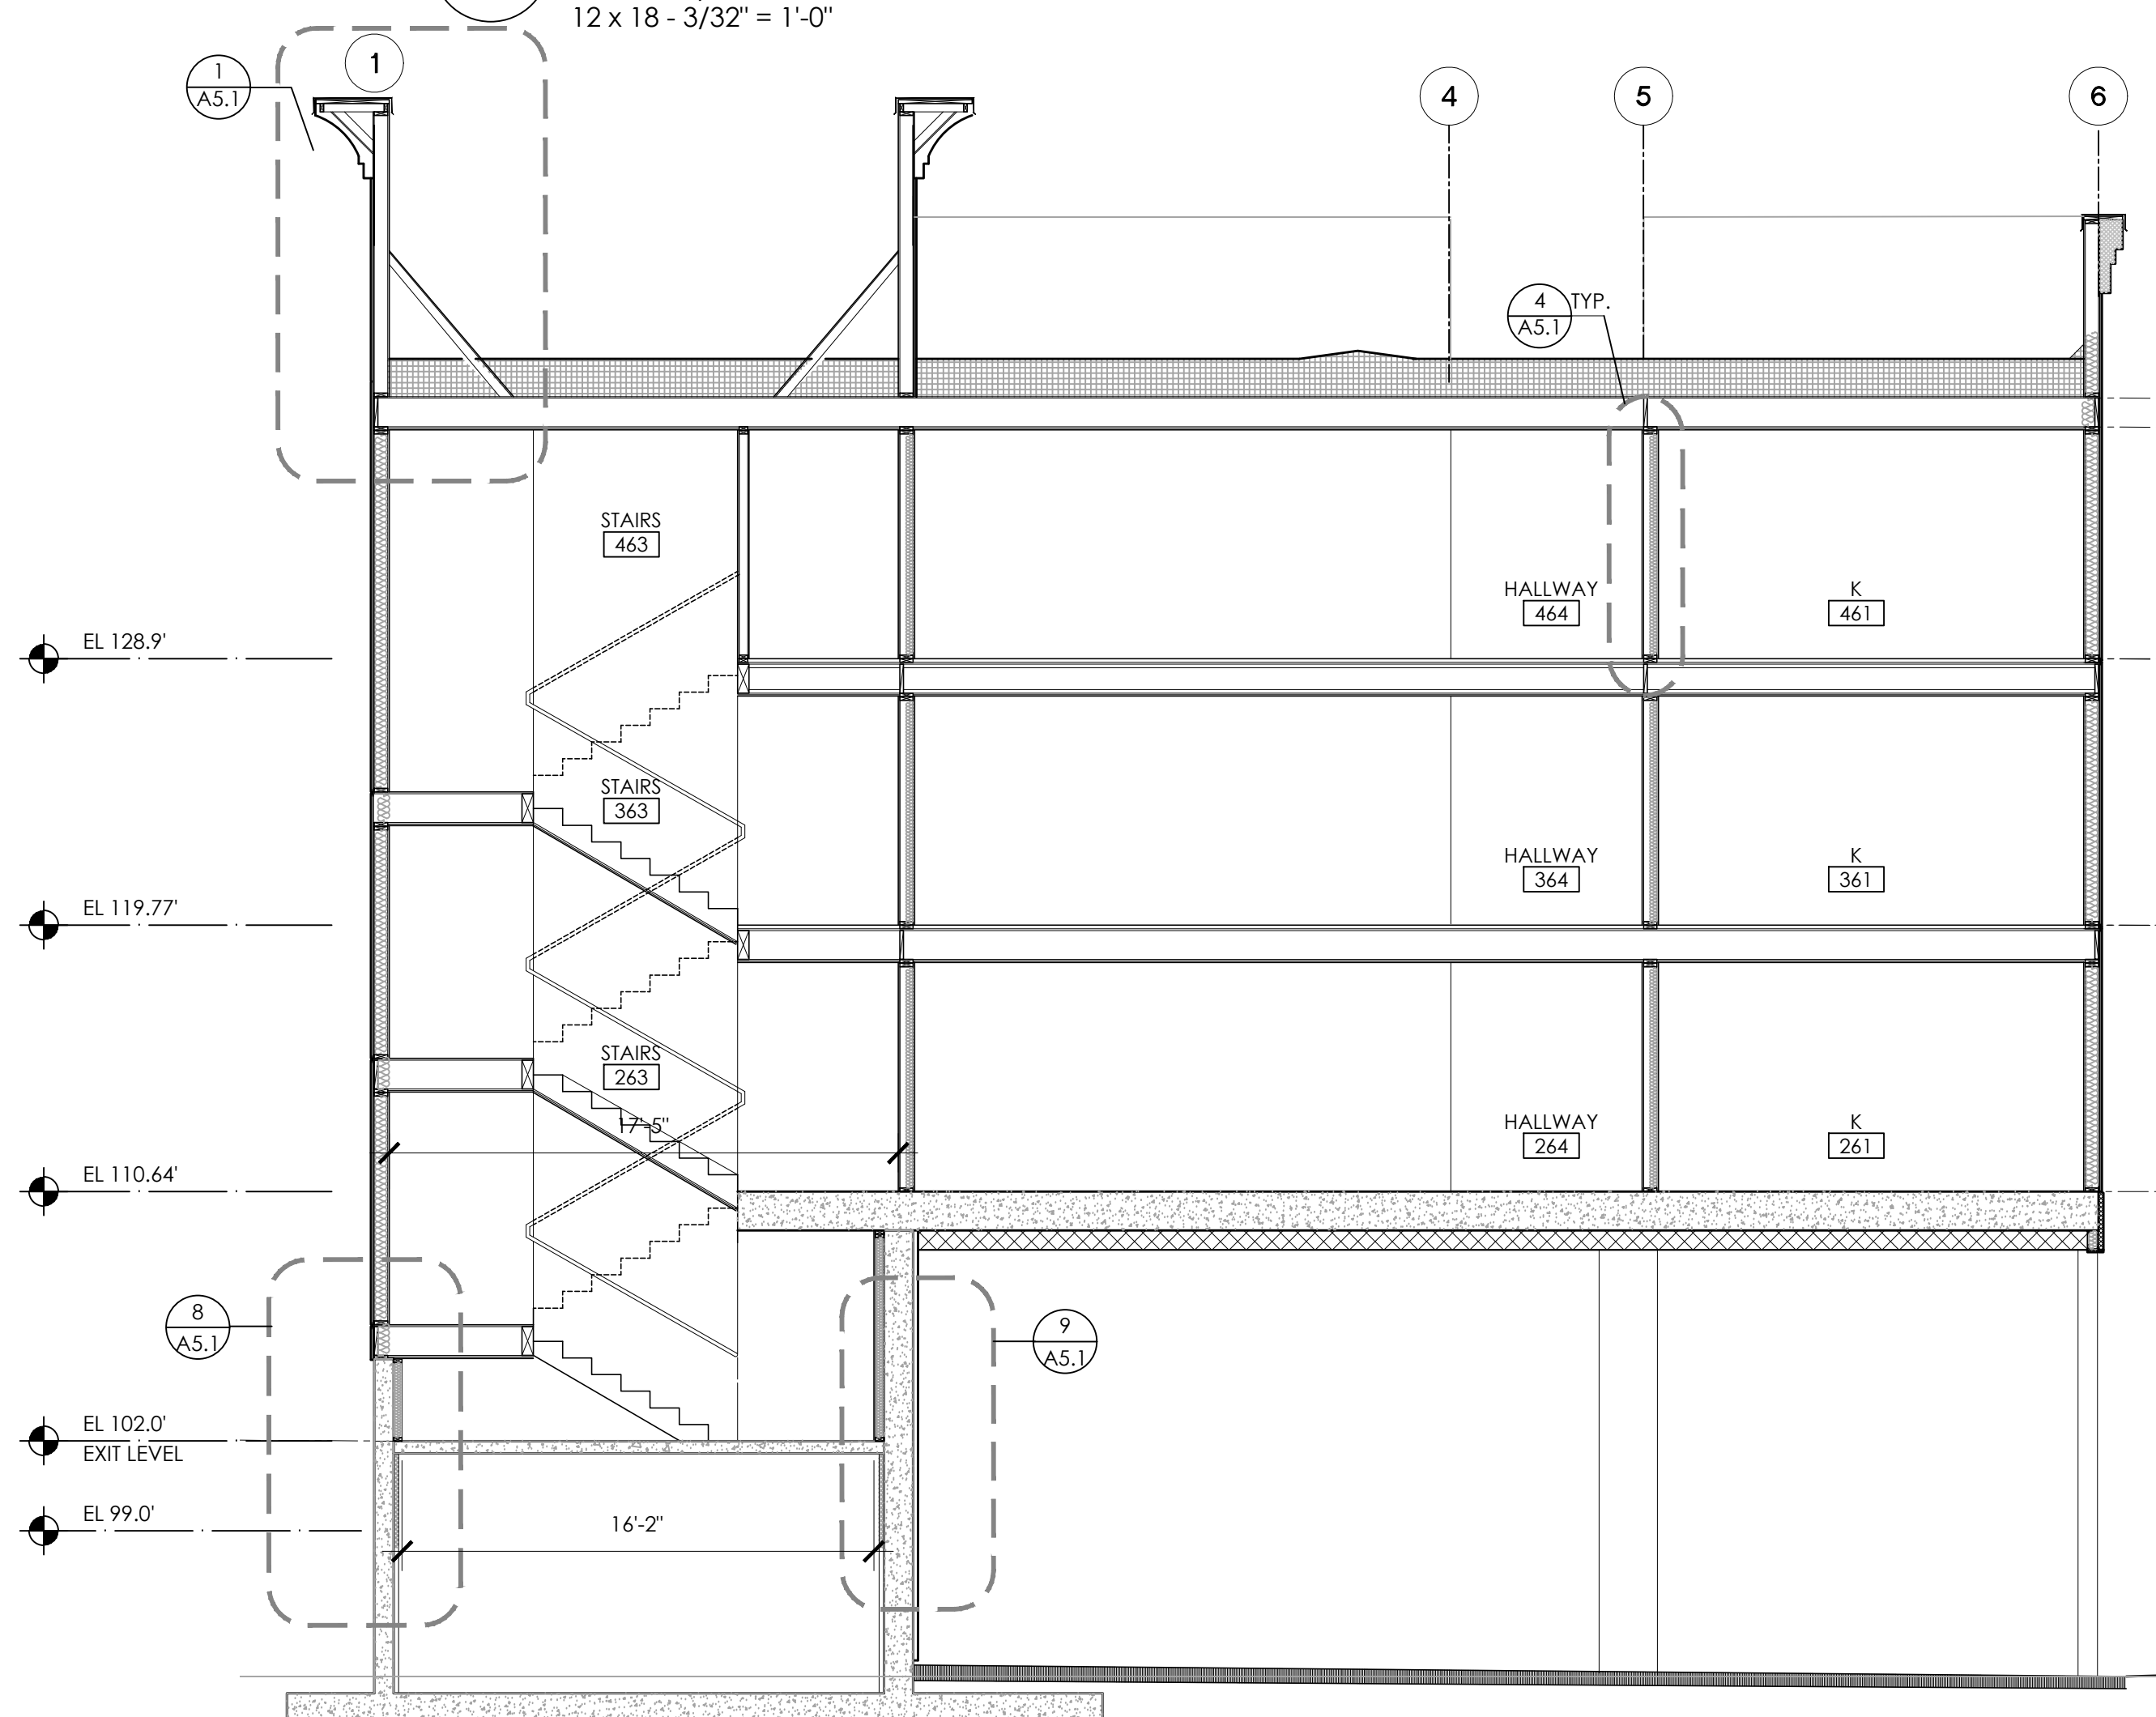

**2 BUILDING SECTION**

24 x 36 - 3/16" = 1'-0"  
12 x 18 - 3/32" = 1'-0"

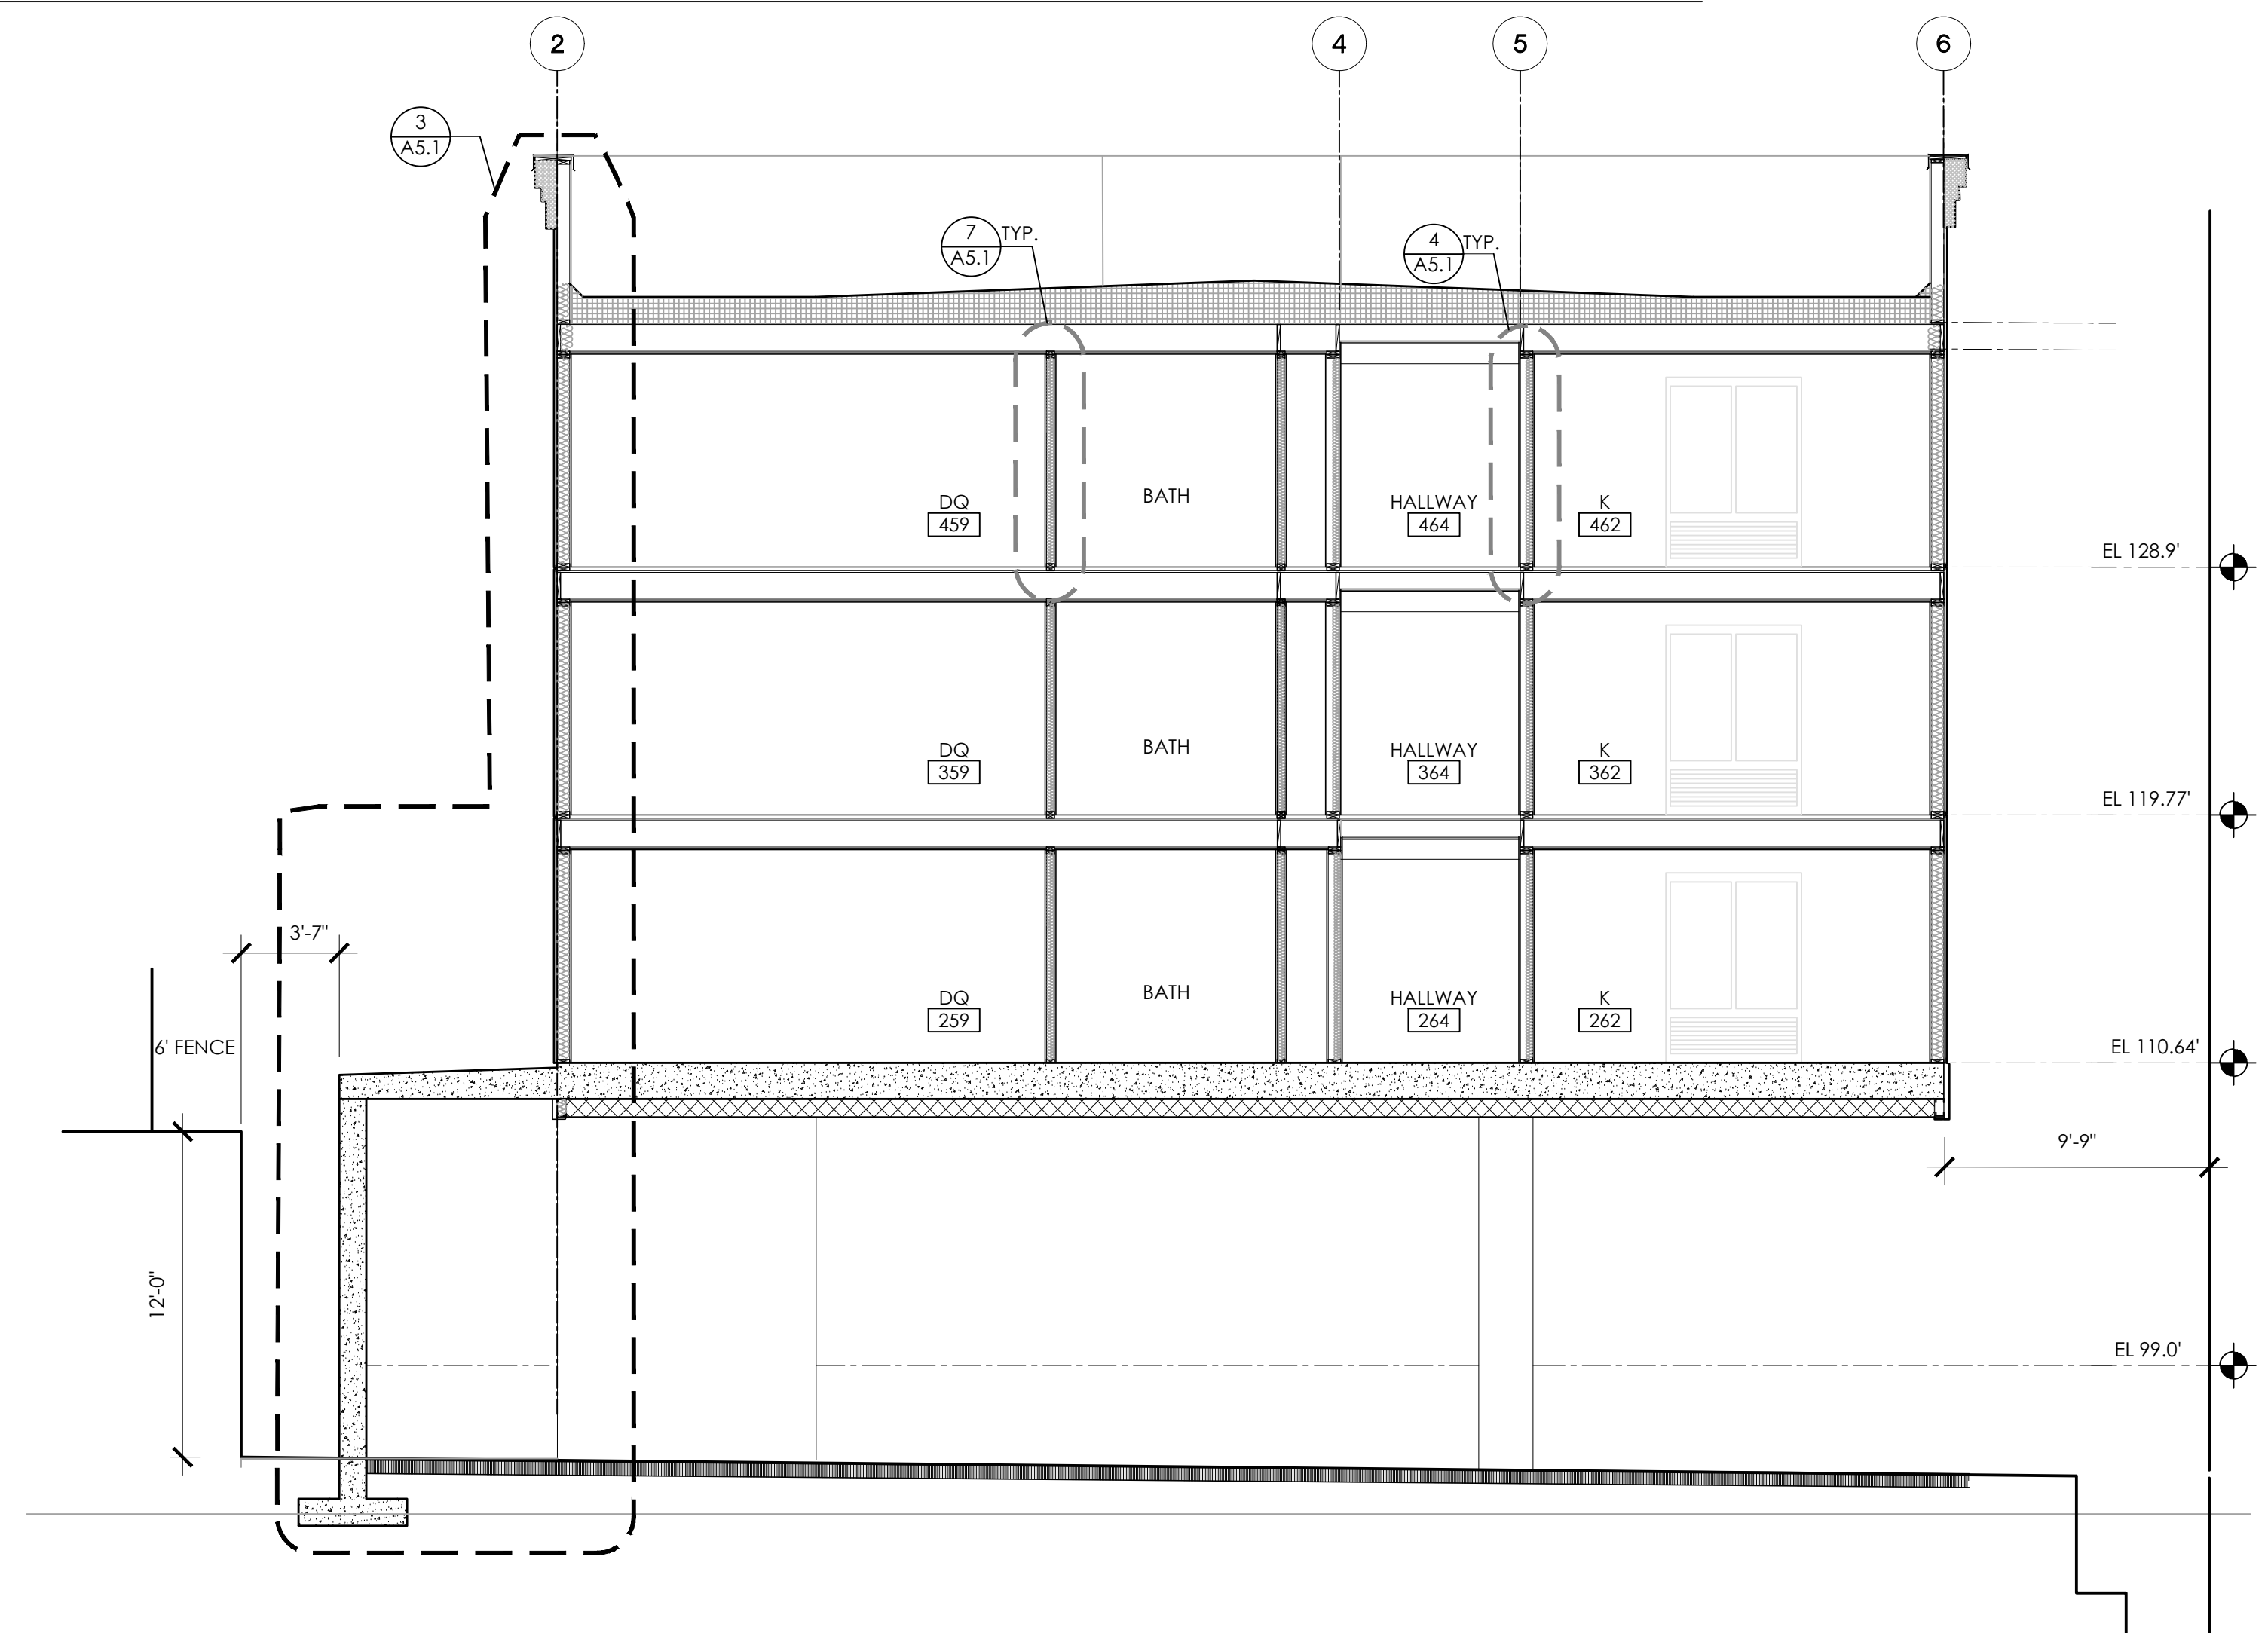

**3 BUILDING SECTION**

24 x 36 - 3/16" = 1'-0"  
12 x 18 - 3/32" = 1'-0"


**BUILDING SECTIONS**

Addition to Hampton Inn & Suites  
Hampton Inn & Suites  
1515 S. Meridian, Puyallup, WA


Job #:  
Date: January 6, 2020  
Revs:

**City of Puyallup**  
Development & Permitting Services  
**ISSUED PERMIT**


Building	Planning
Engineering	Public Works
Fire	Traffic

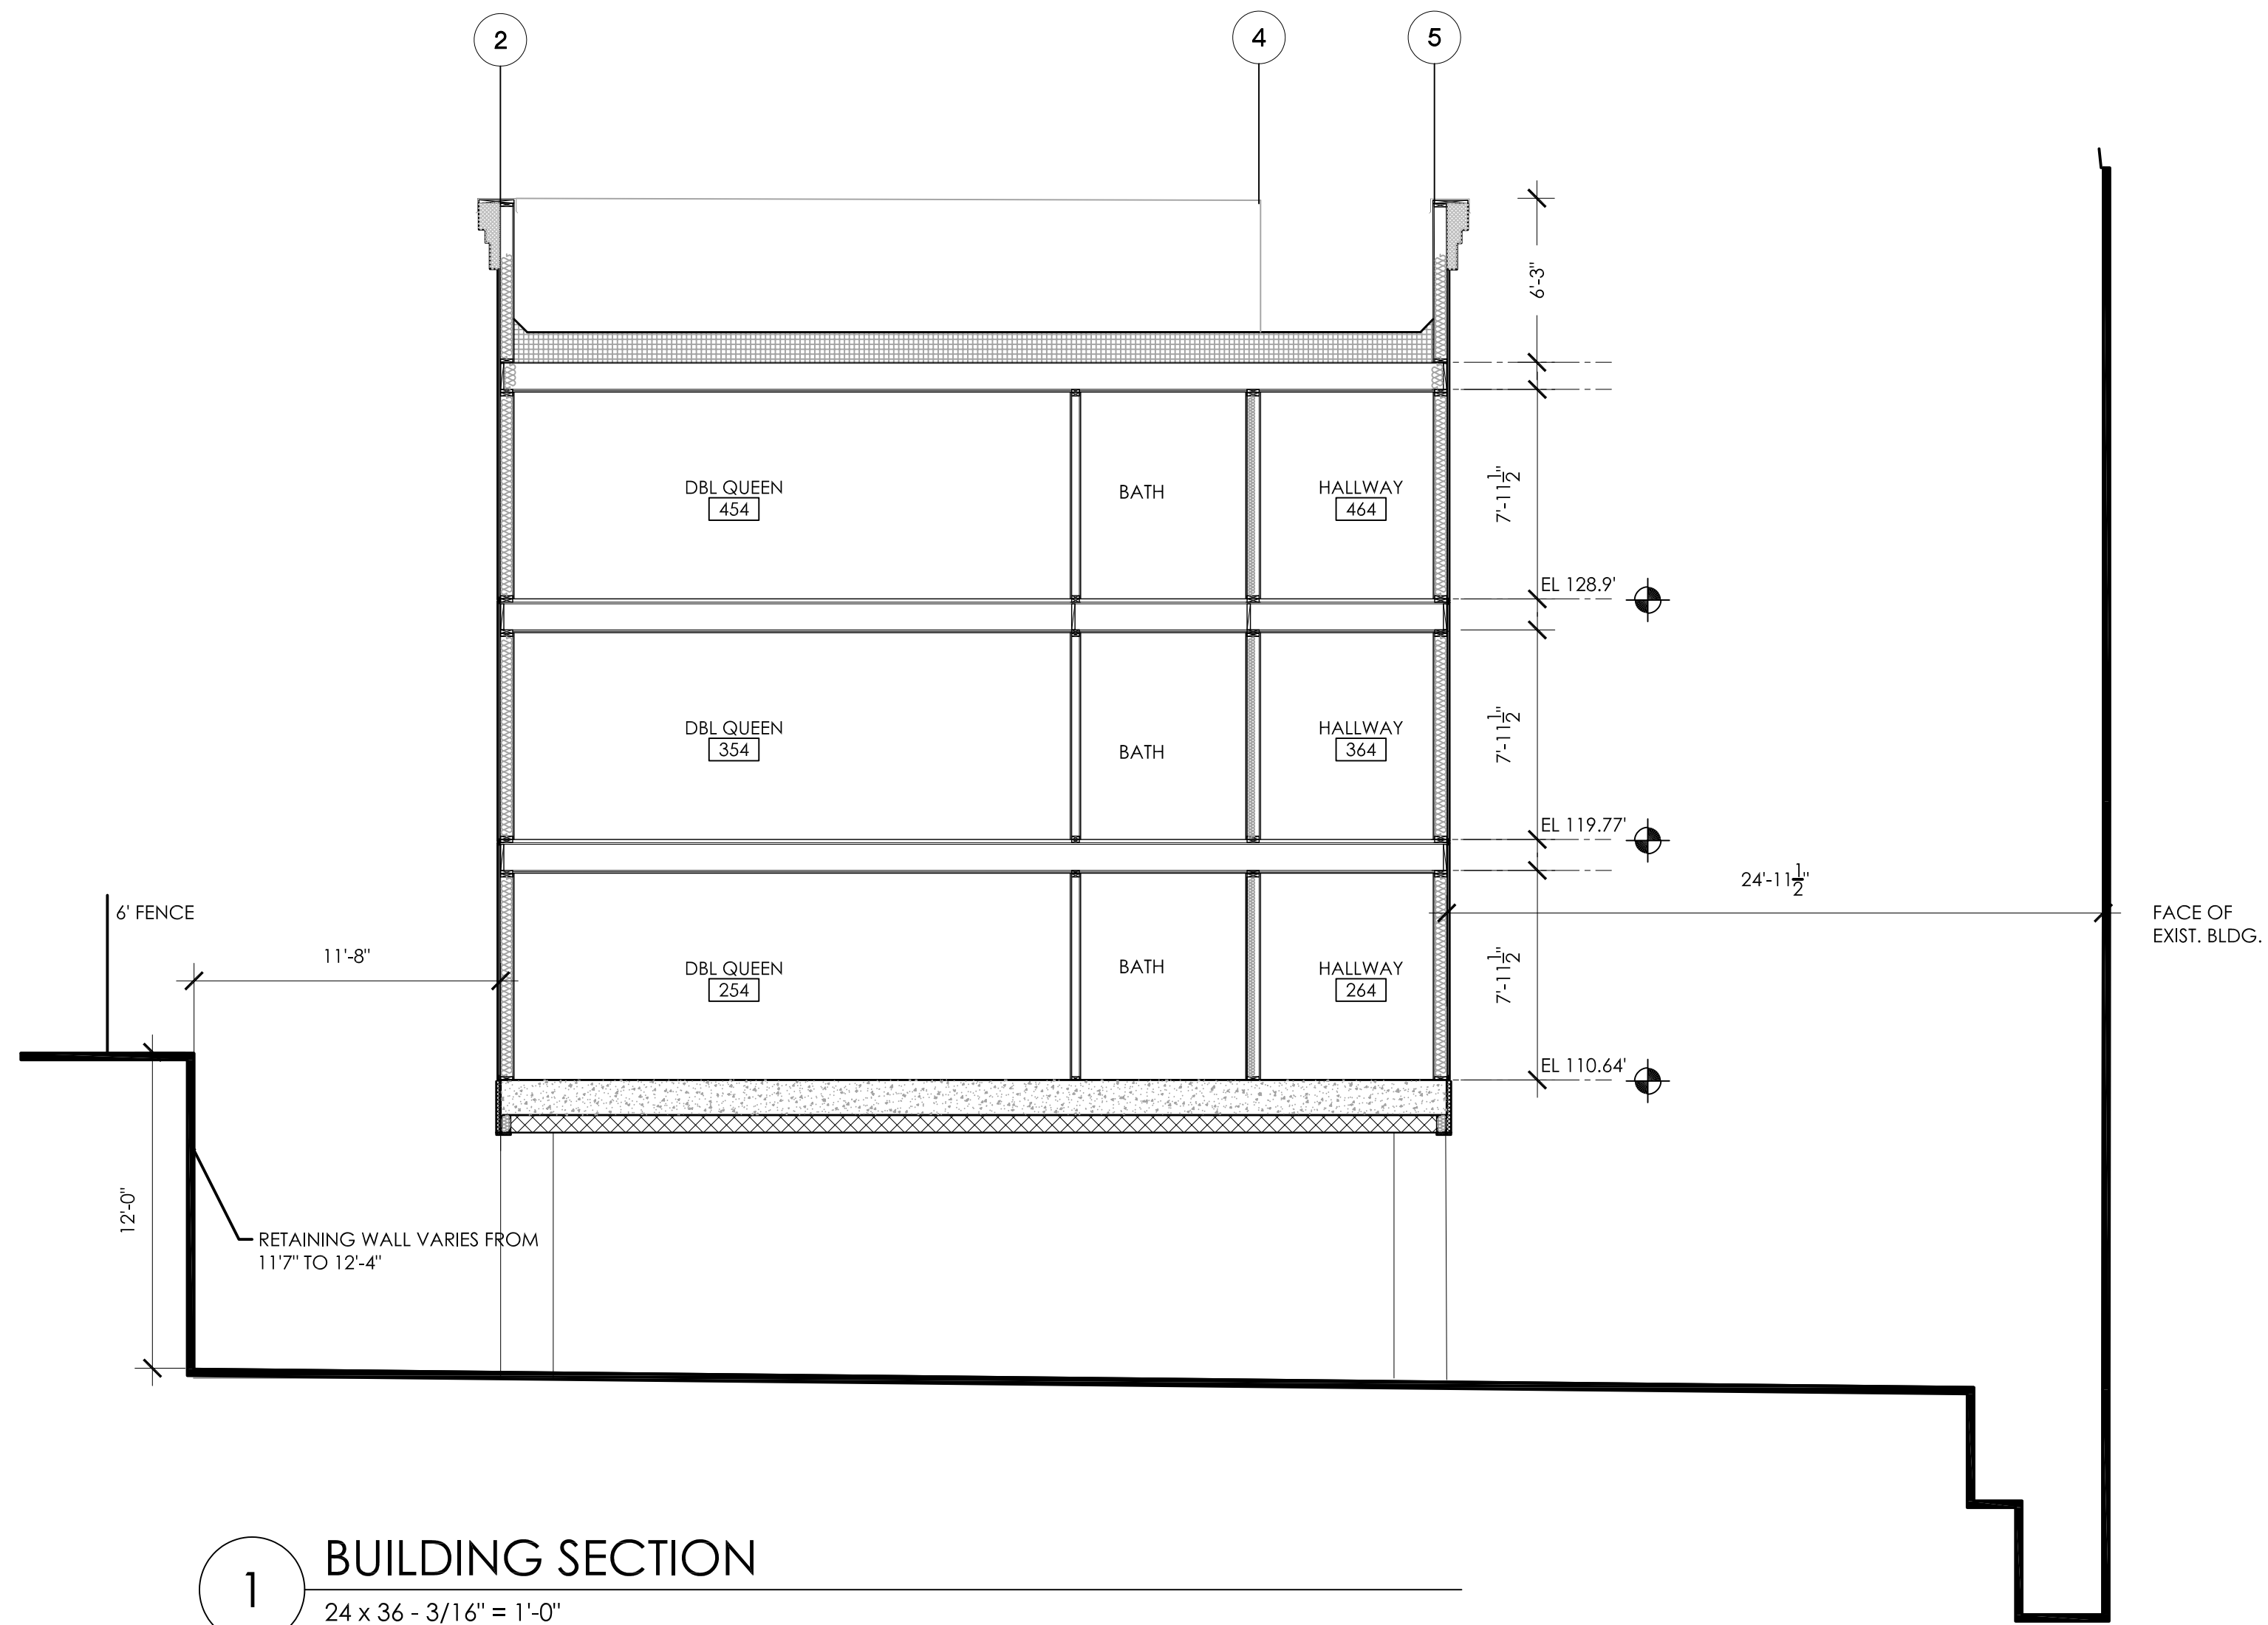

**1 BUILDING SECTION**  
24 x 36 - 3/16" = 1'-0"  
12 x 18 - 3/32" = 1'-0"

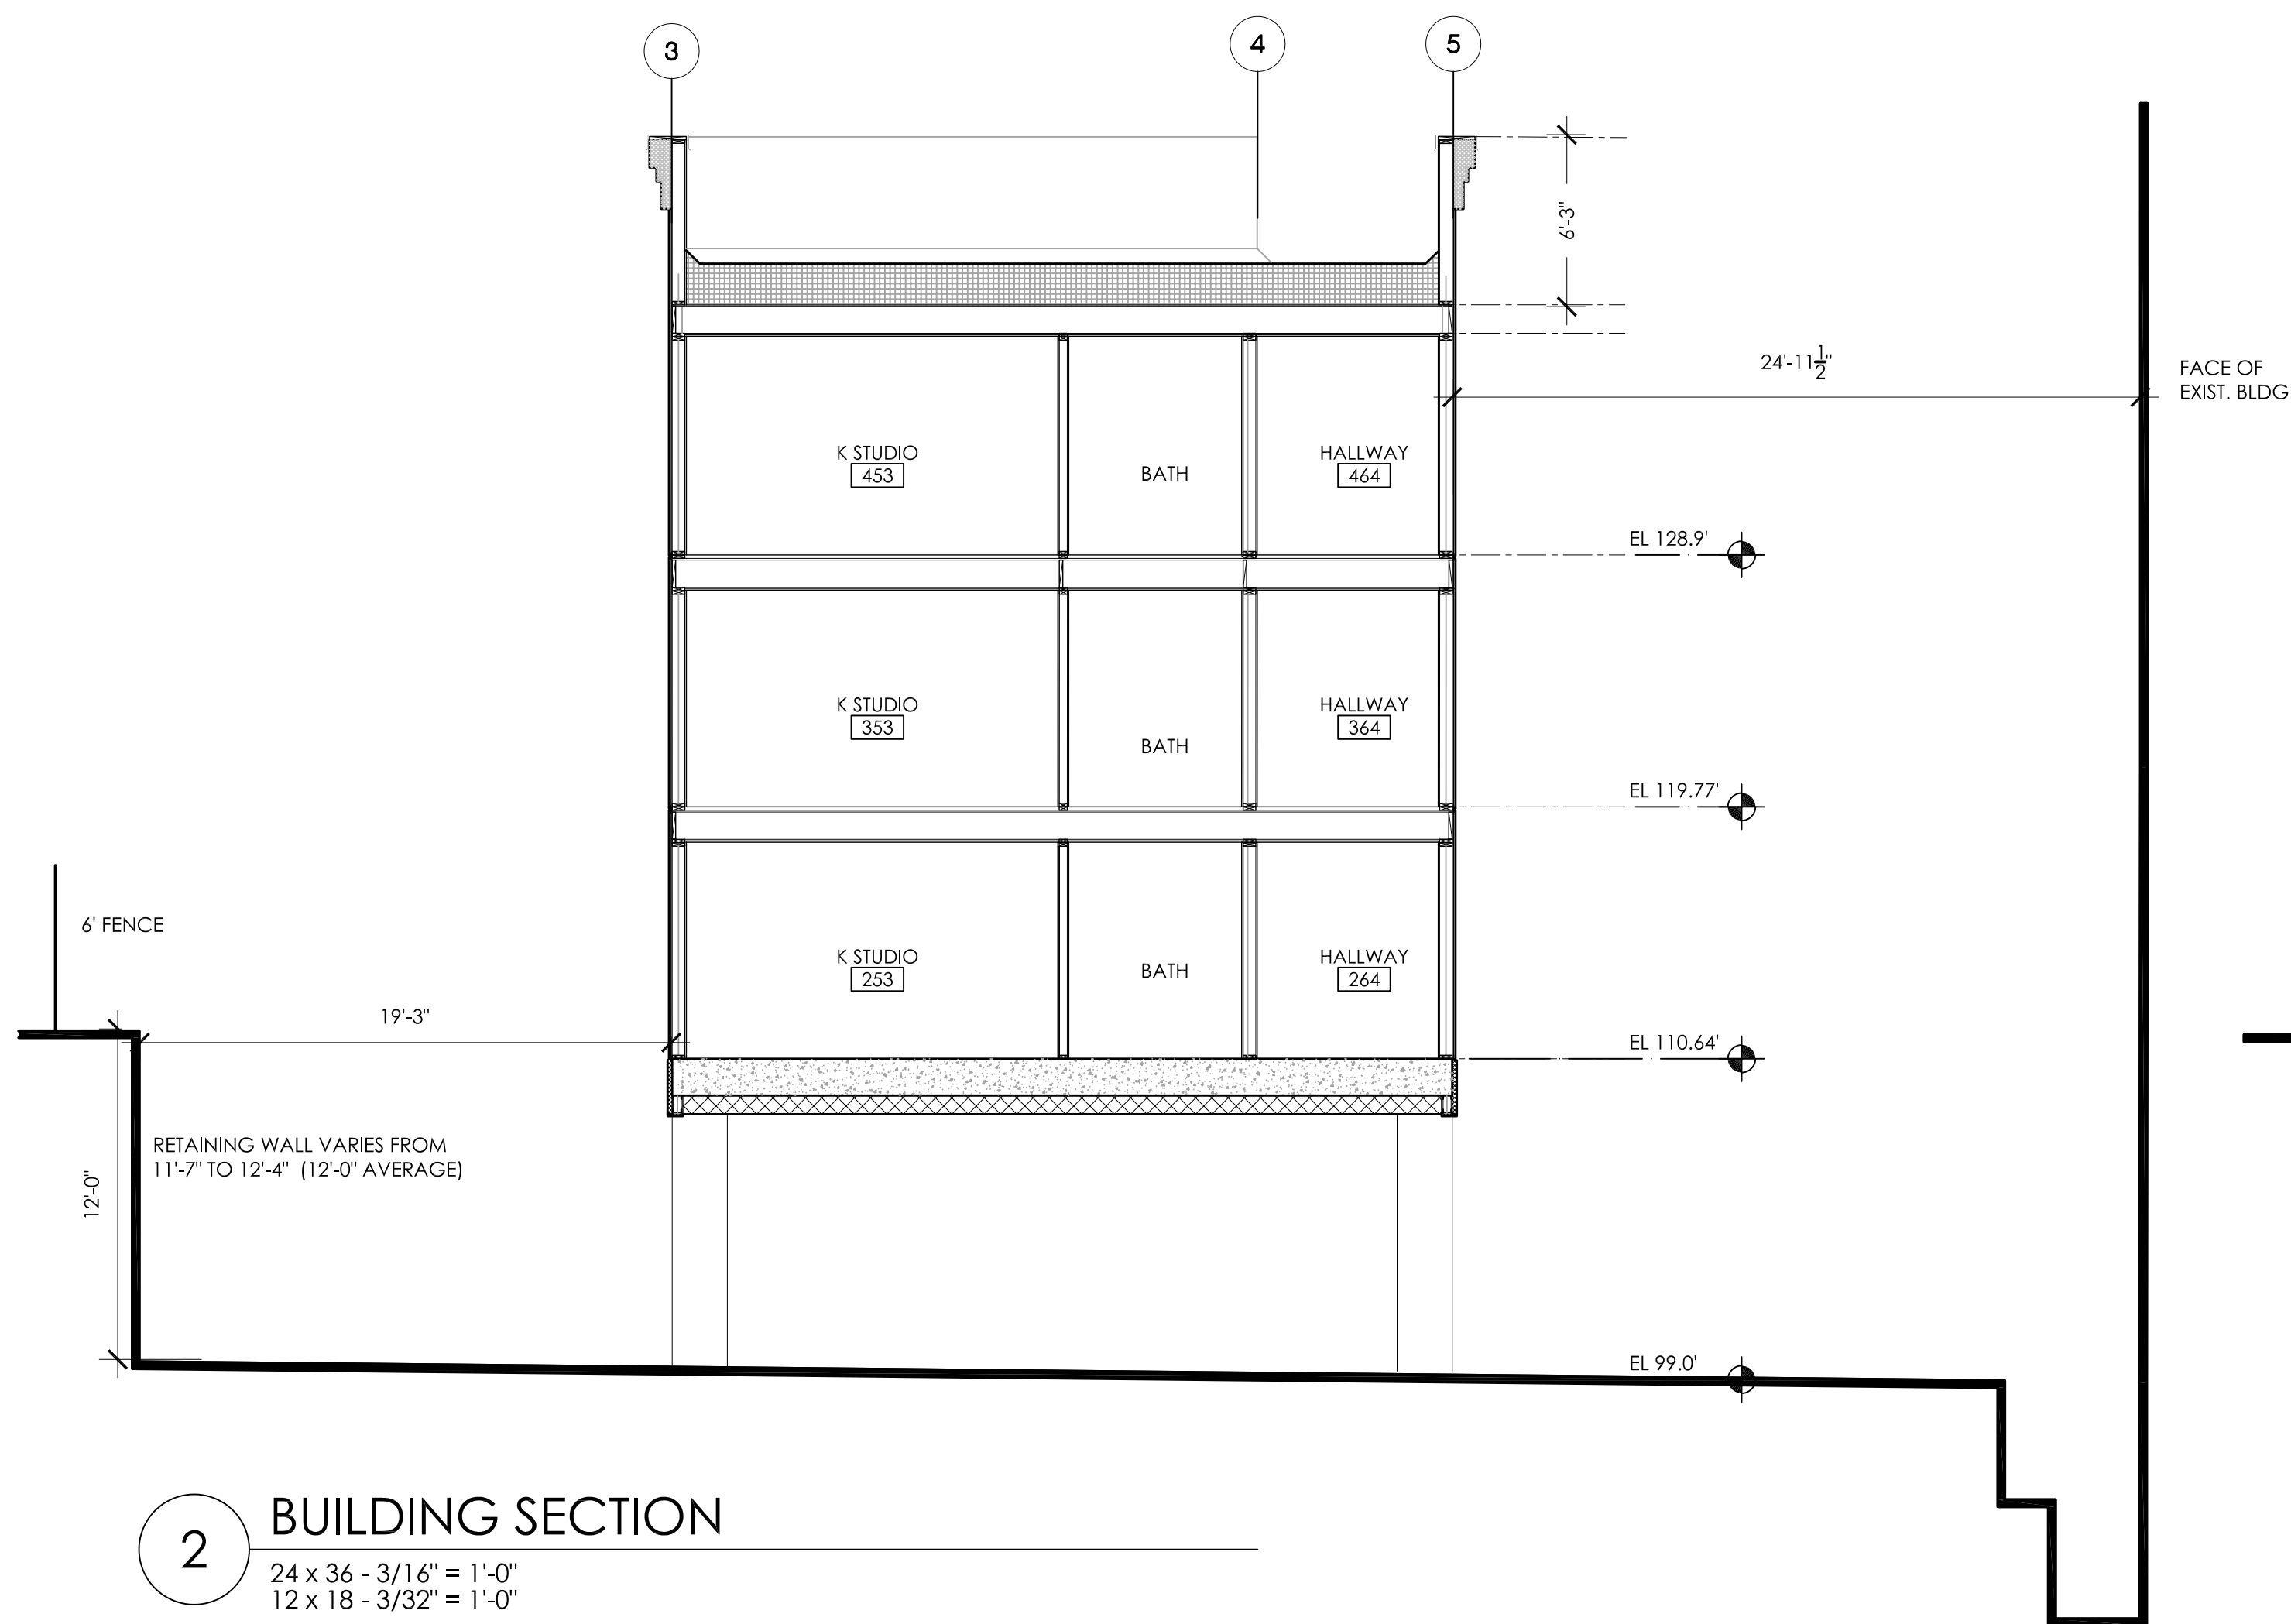


**2 BUILDING SECTION**  
24 x 36 - 3/16" = 1'-0"  
12 x 18 - 3/32" = 1'-0"

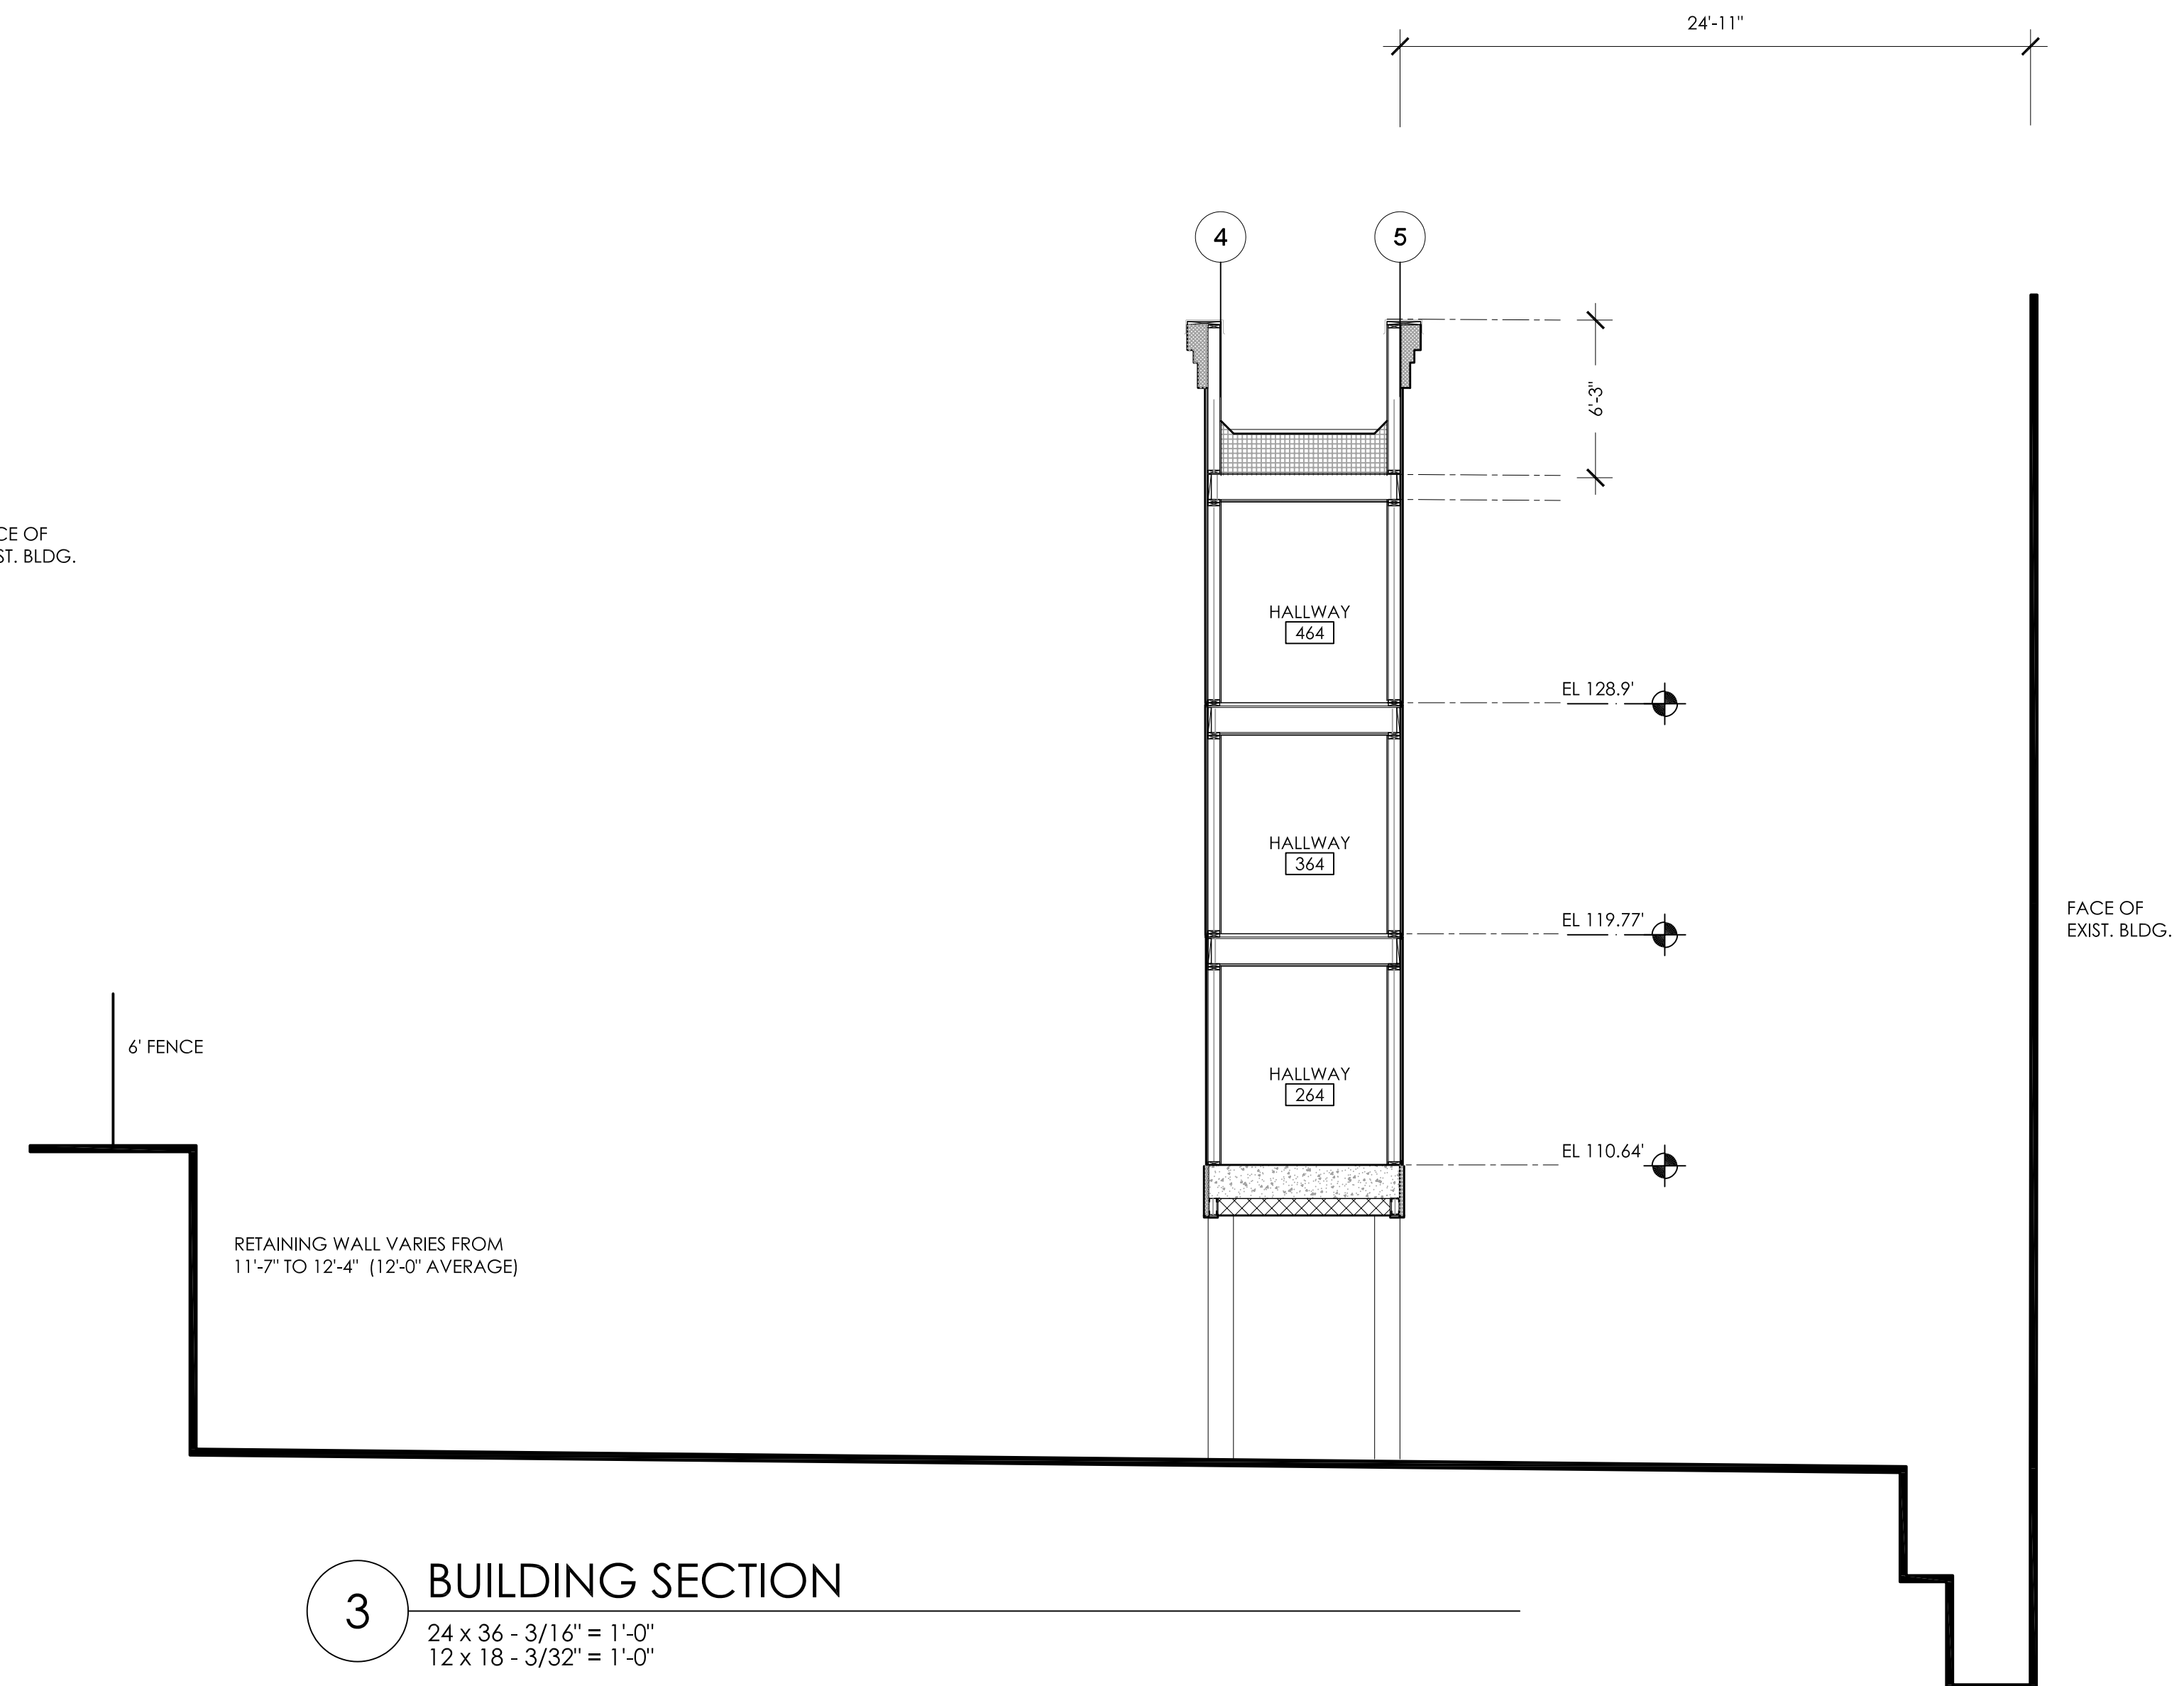


**3 BUILDING SECTION**  
24 x 36 - 3/16" = 1'-0"  
12 x 18 - 3/32" = 1'-0"

**BUILDING SECTIONS**  
Addition to Hampton Inn & Suites  
Hampton Inn & Suites  
1515 S. Meridian, Puyallup, WA


Job #:  
Date:  
Revs: March 10, 2020

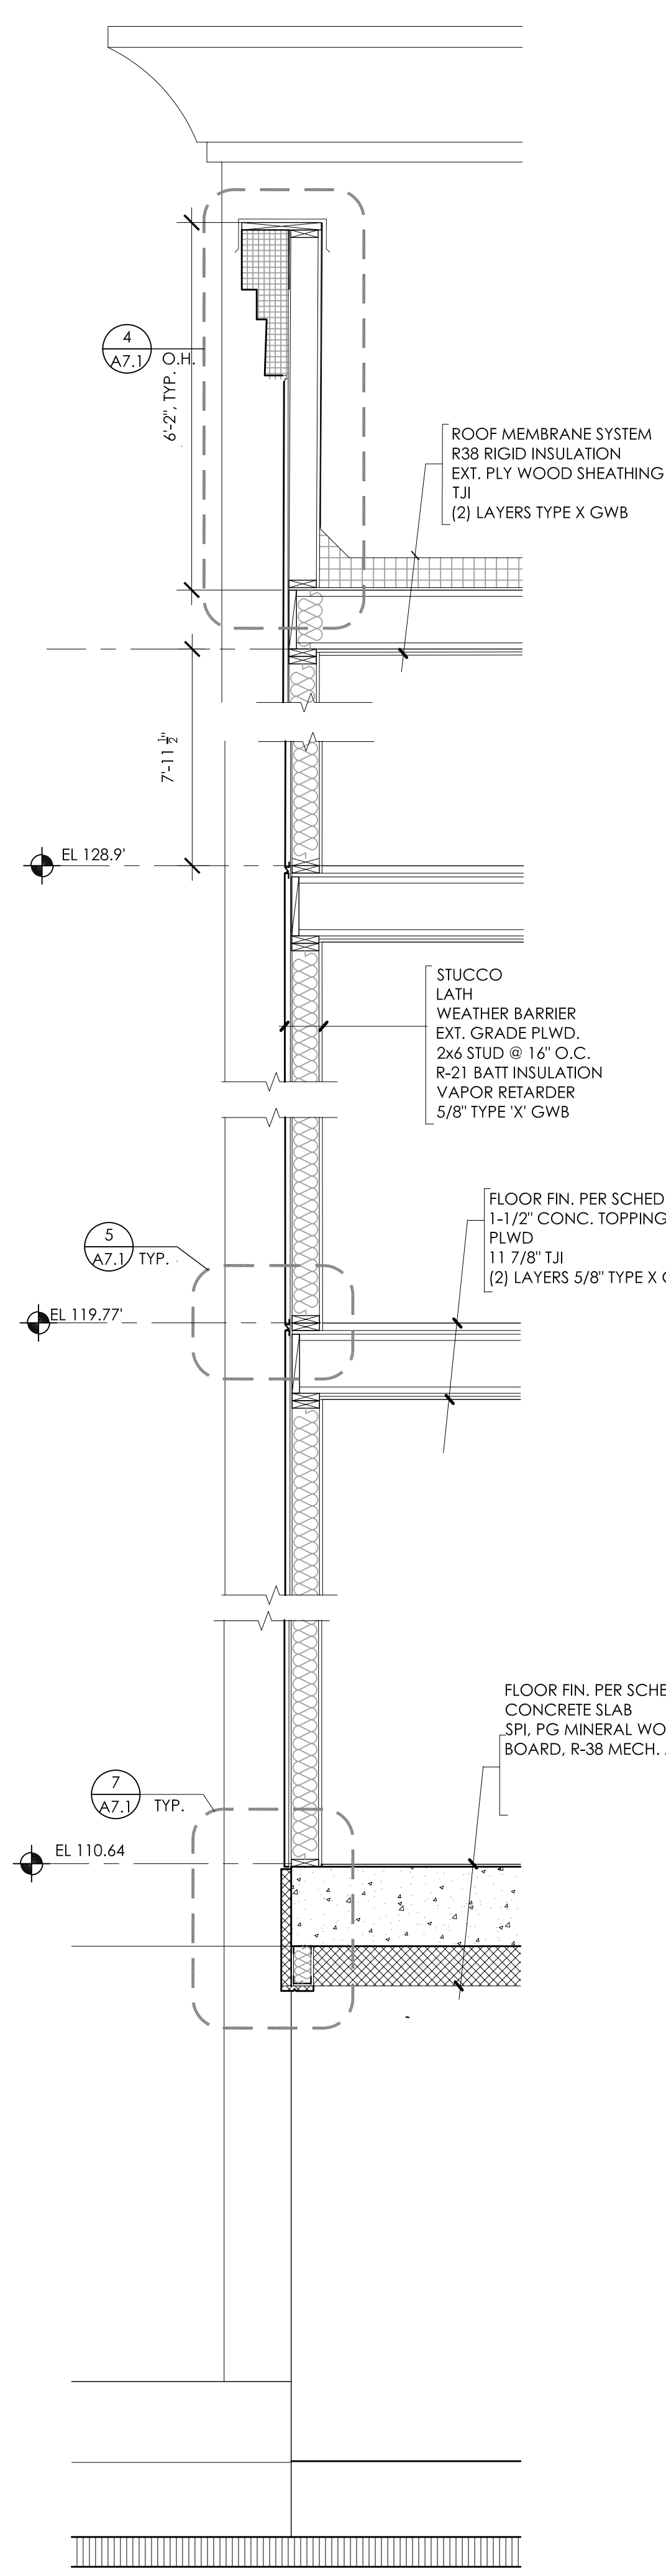


1 TYP. EXT. WALL SECTION  
24 x 36 - 1/2" = 1'-0"  
12 x 18 - 1/4" = 1'-0"

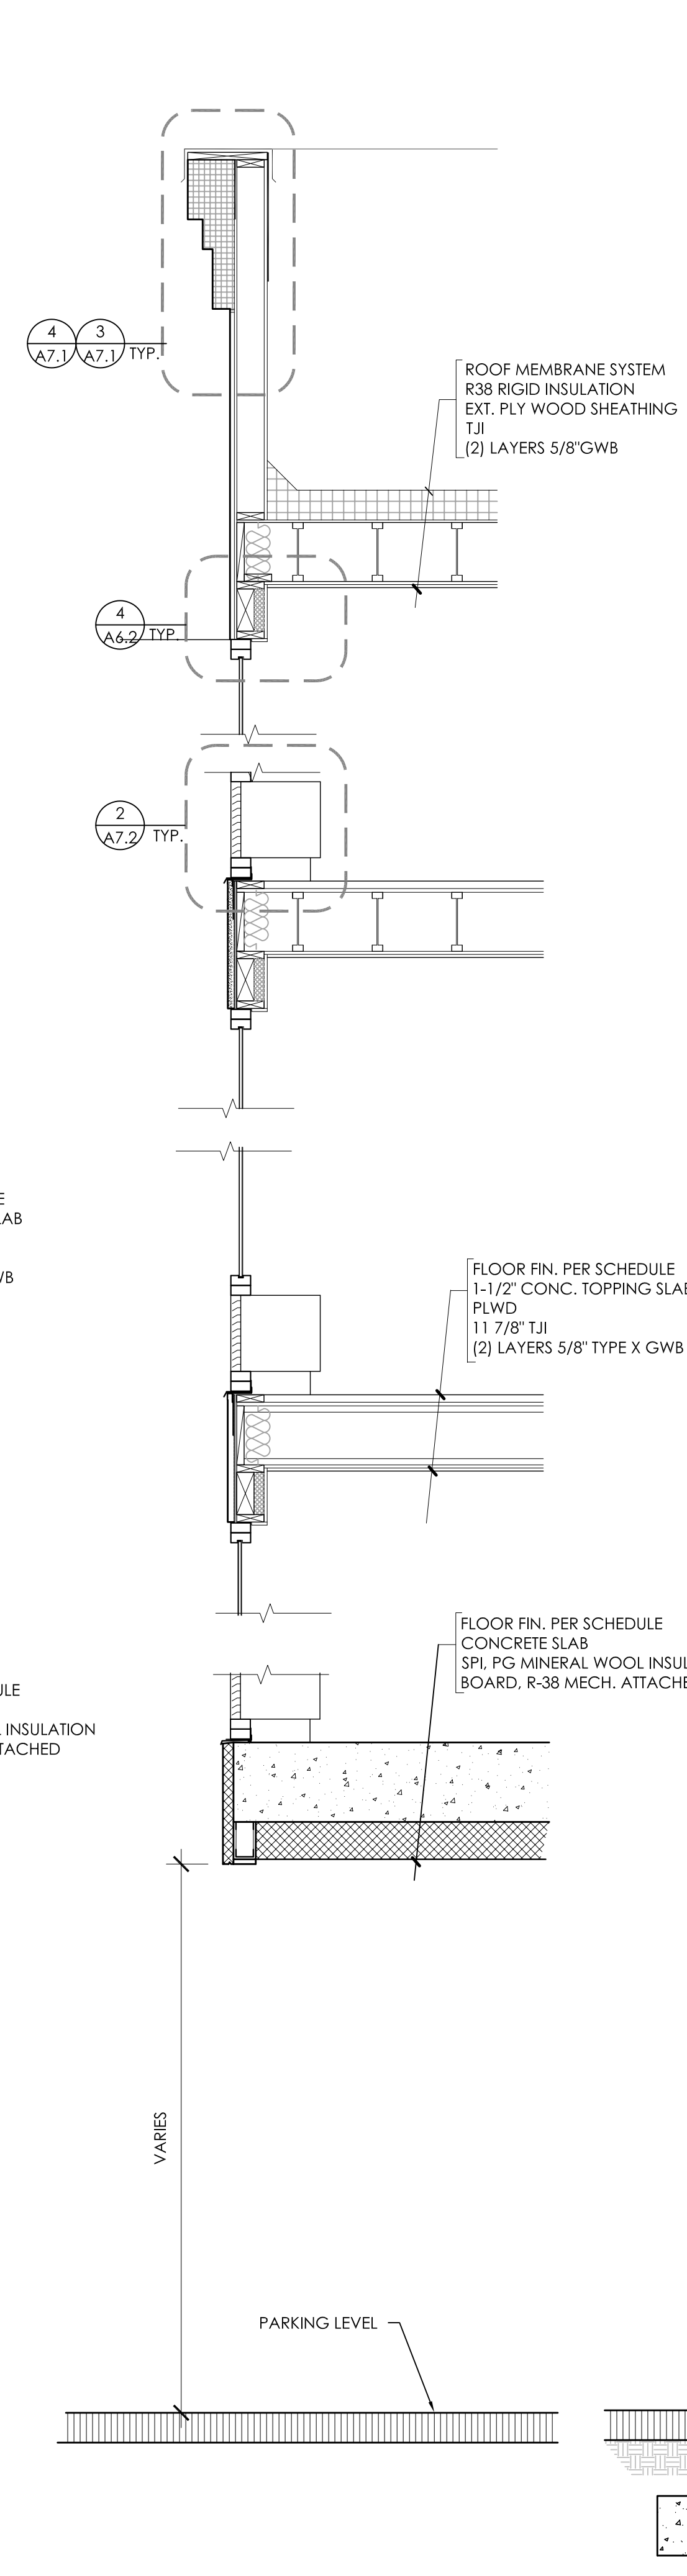


2 TYP. EXT. WALL SECTION  
24 x 36 - 1/2" = 1'-0"  
12 x 18 - 1/4" = 1'-0"

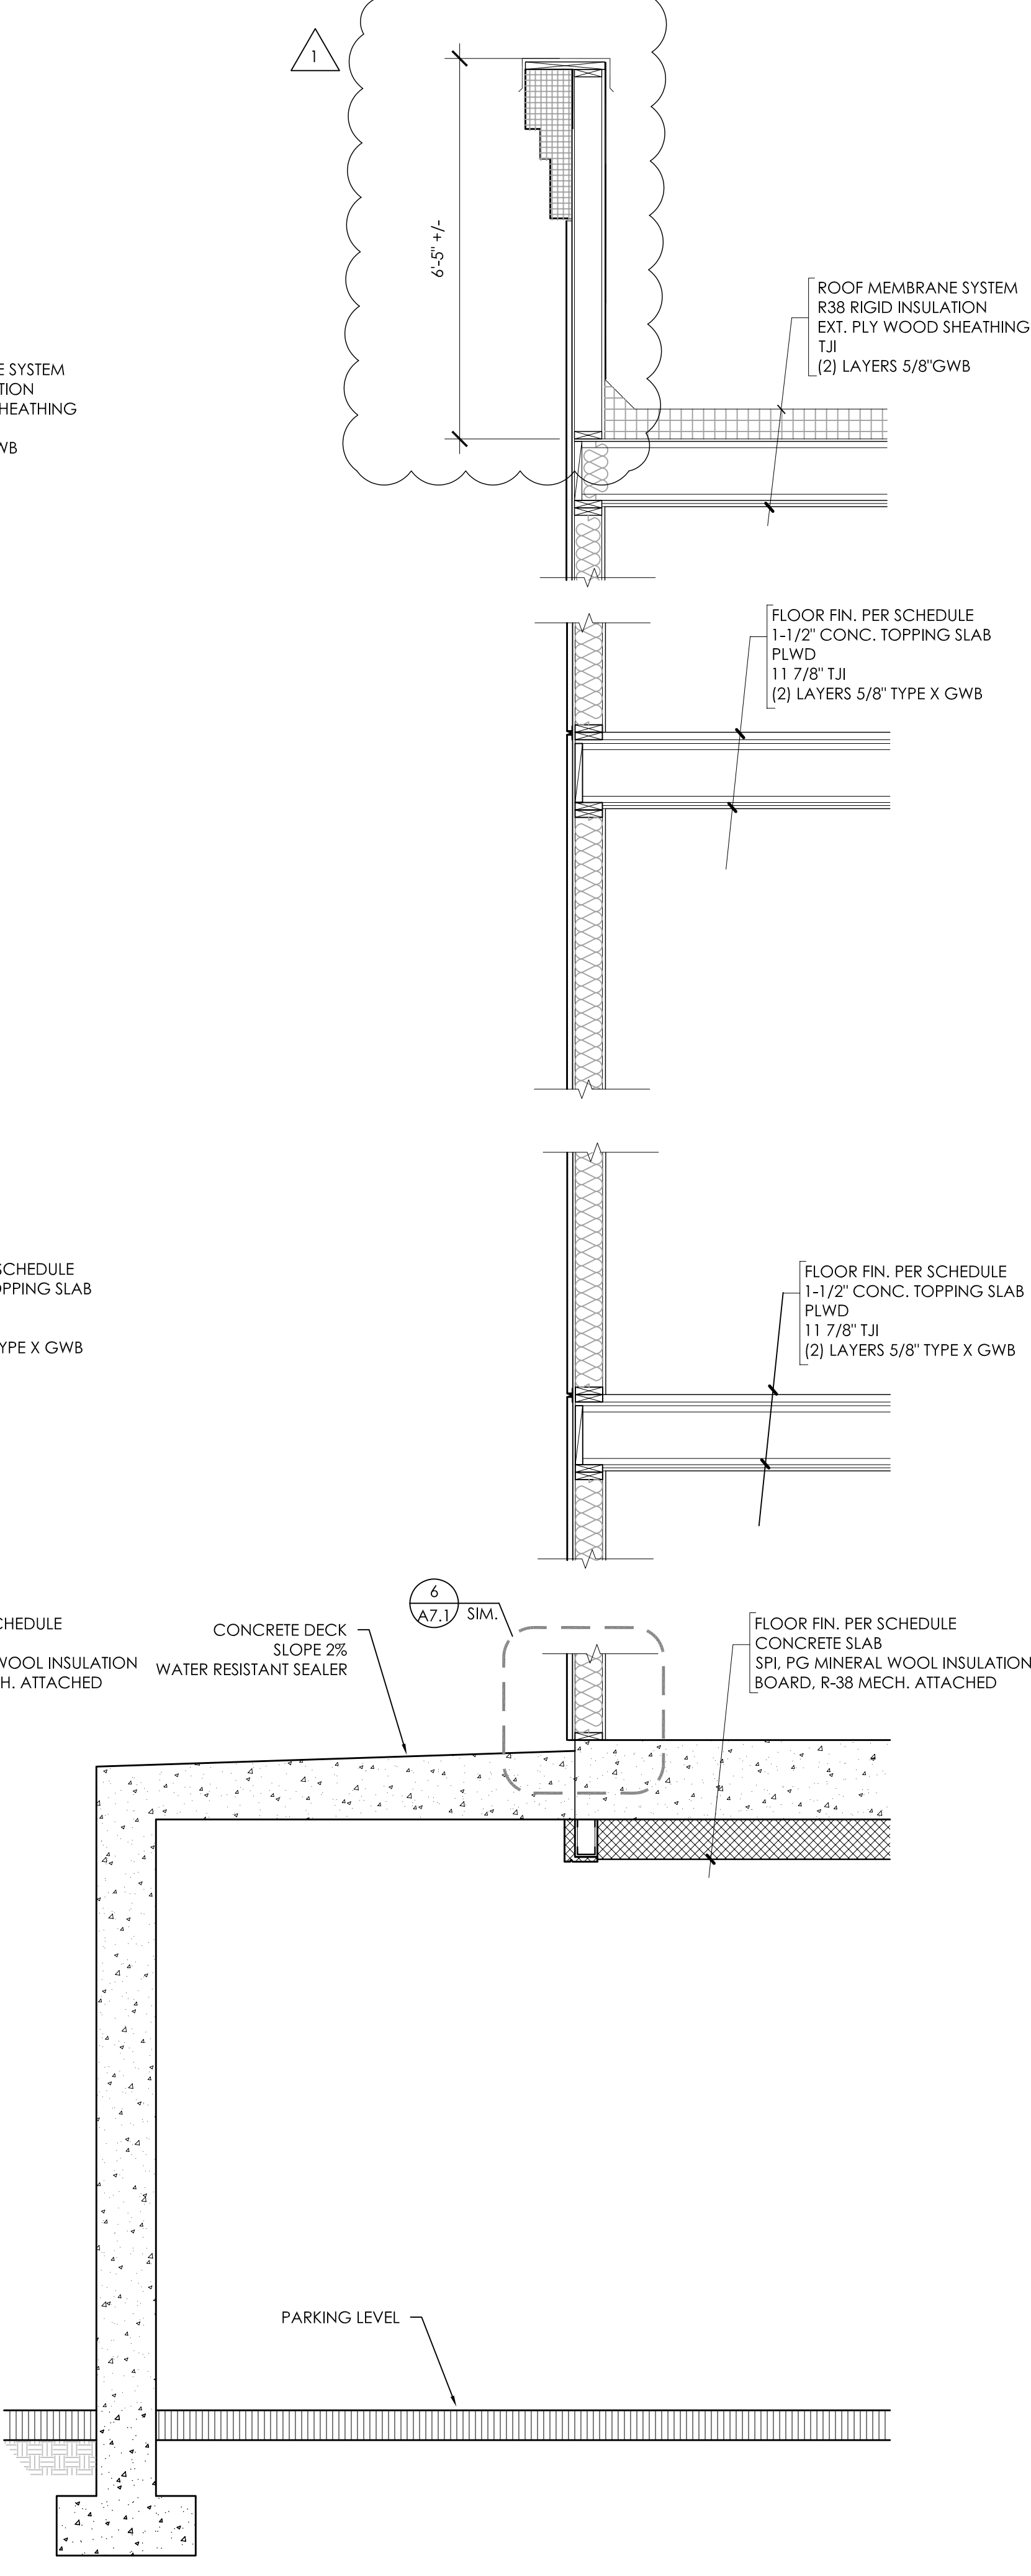

3 WALL SECTION  
24 x 36 - 1/2" = 1'-0"  
12 x 18 - 1/4" = 1'-0"

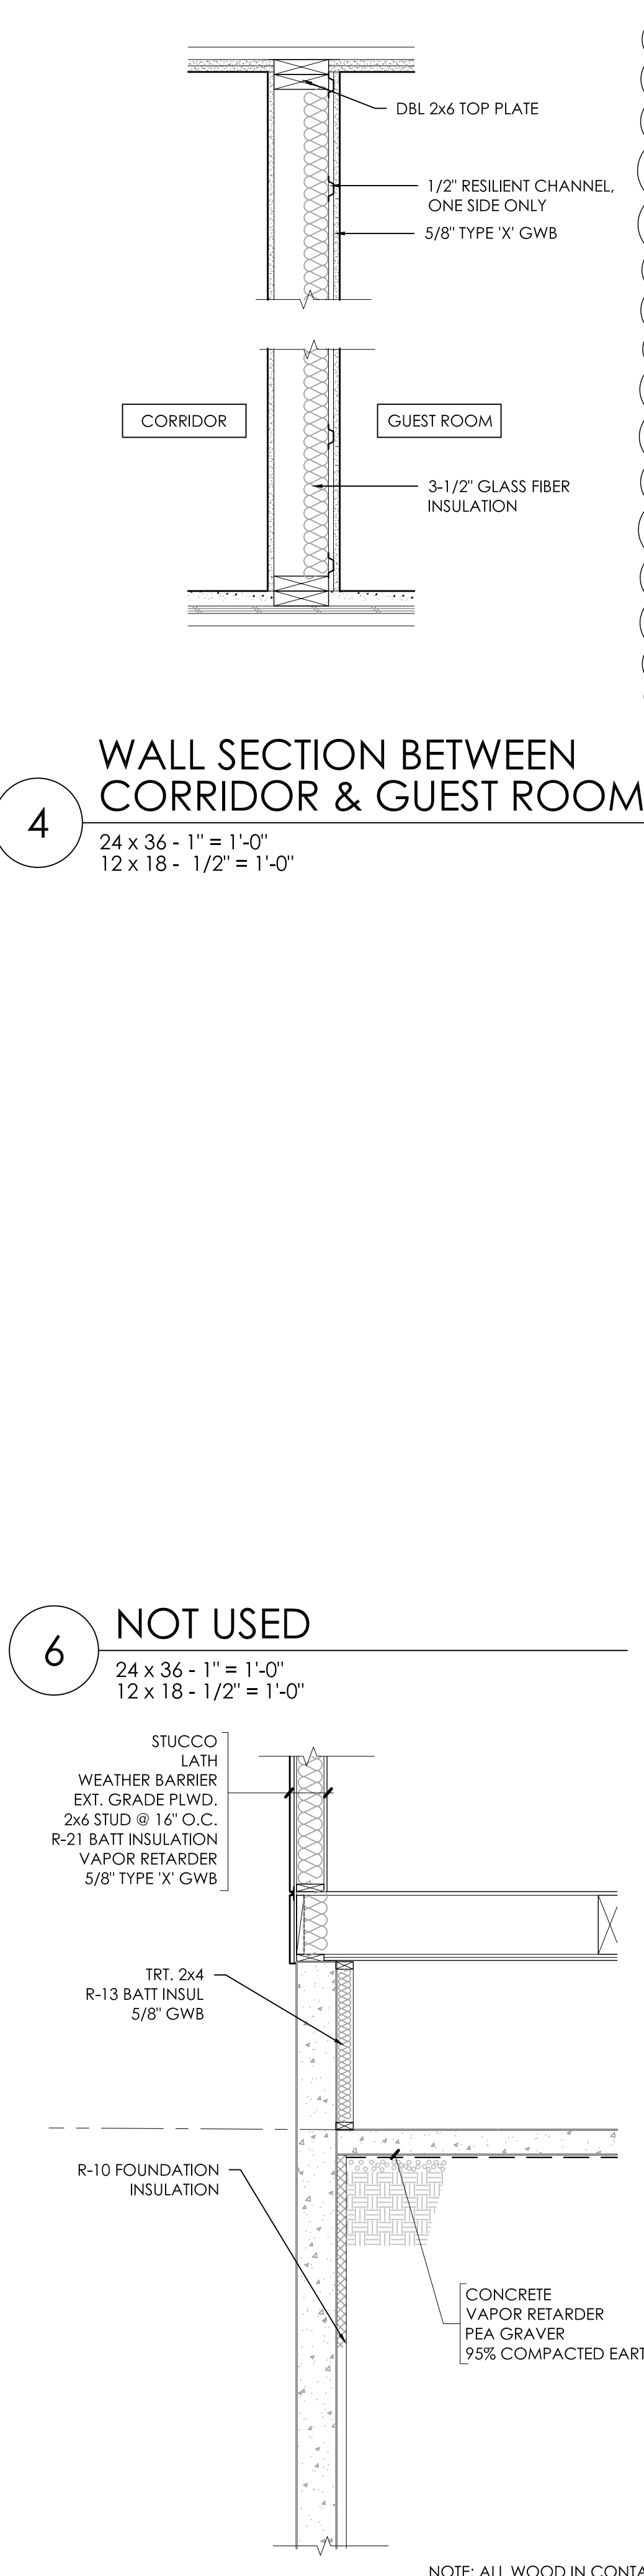

4 SECTION @ STAIR  
24 x 36 - 1" = 1'-0"  
12 x 18 - 1/2" = 1'-0"

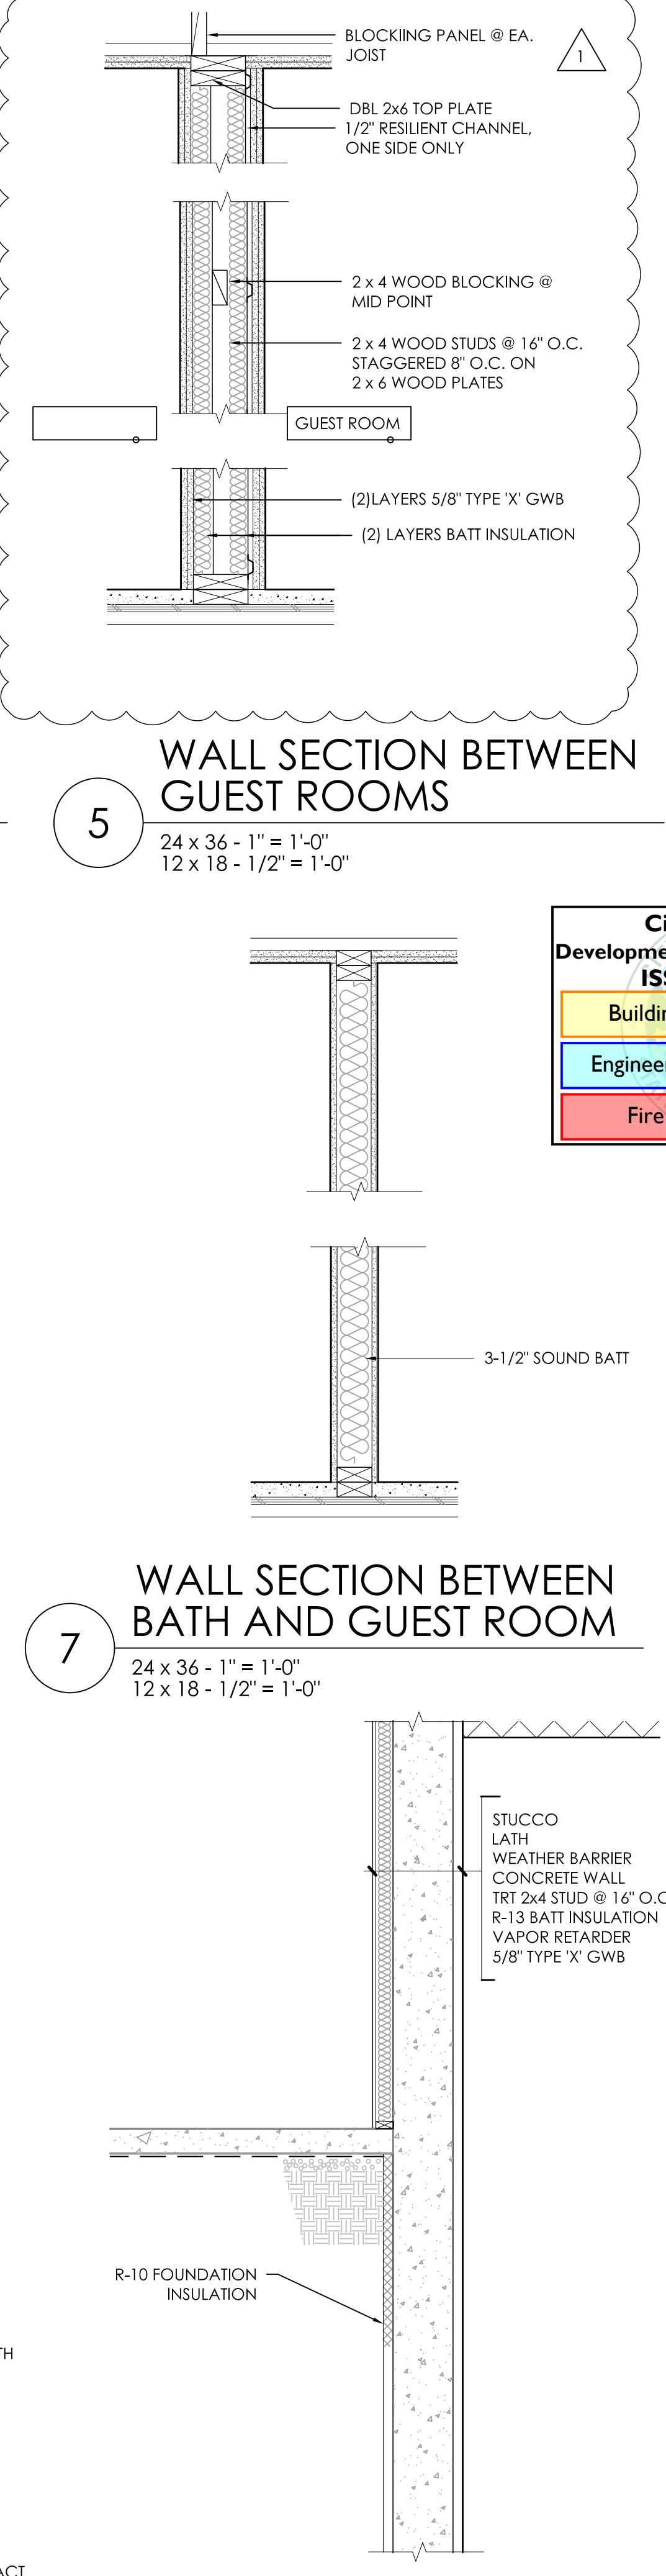

5 SECTION @ STAIR  
24 x 36 - 1" = 1'-0"  
12 x 18 - 1/2" = 1'-0"

City of Puyallup  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

WALL SECTIONS  
 Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA

Job #:  
Date: January 6, 2020  
Revs: March 10, 2020

# DOOR SCHEDULE

DOOR NO.	DOOR SIZE	DOOR TYPE	DOOR CORE	MAT	FIN	FRAME TYP	RATING	HDW GRP	DETAILS HEAD	JAMB	SILL	REMARKS
100A	3'-0" x 7'-0" x 1 3/4"	A	INSUL	HM	PAINT	A	HM	--				
136A	3'-0" x 7'-0" x 2"	E	ALUM									
253A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
253B	3'-0" x 6'-8" x 1 3/4"	C	SC	WD	PAINT	A	HM	--				SEE NOTE 2
253C	PR 1'-8" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING, MOUNT TRACK BEHIND WALL
254A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
254B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
254C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
255A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
255B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
255C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
256A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
256B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
256C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
257A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
257B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
257C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
258A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
258B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
258C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
259A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
259B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
259C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
260A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
260B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
260C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
261A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
261B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
261C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
262A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
262B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
262C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
263	3'-0" x 7'-0" x 1 3/4"	D	HM	MTL	PAINT	A	HM	60 MIN.				INSULATED, SEE NOTES 5, 7
264	PR 3'-0" x 6'-8" x 1 3/4"	A	SC	WD	PAINT	A	HM	20 MIN.				SEE NOTES 1,3,5
265	PR 3'-0" x 6'-8" x 1 3/4"	A	SC	WD	PAINT	A	HM	20 MIN.				SEE NOTES 1,3,5
353A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
353B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
353C	1'-8" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
354A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
354B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
354C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
355A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
355B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
355C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
356A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
356B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
356C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
357A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
357B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
357C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
358A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
358B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
358C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
359A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
359B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
359C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
360A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
360B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
360C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
361A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
361B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
361C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
362A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
362B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
362C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
363	3'-0" x 7'-0" x 1 3/4"	D	HM	MTL	PAINT	A	HM	60 MIN.				INSULATED, SEE NOTES 5, 7
364	PR 3'-0" x 7'-0" x 1 3/4"	A	SC	WD	PAINT	A	HM	20 MIN.				SEE NOTES 1,3,5
365	PR 3'-0" x 7'-0" x 1 3/4"	A	SC	WD	PAINT	A	HM	20 MIN.				SEE NOTES 1,3,5
453A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
453B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
453C	1'-8" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
454A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
454B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
454C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
455A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
455B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
455C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
456A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
456B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
456C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
457A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
457B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
457C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
458A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
458B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
458C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
459A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
459B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
459C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
460A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
460B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
460C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
461A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
461B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
461C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
462A	3'-0" x 6'-8" x 1 3/4"	A	SC	WD	NOTE 1	A	HM	20 MIN.				SEE NOTES 1,3,4,5,6
462B	3'-0" x 6'-8" x 1 3/4"	B	SC	WD	PAINT	A	HM	--				SEE NOTE 2
462C	2'-6" x 6'-8" x 1 3/4"	C	SC	WD	MIRROR	--	--	--				FRAMED OPENING
463	3'-0" x 7'-0" x 1 3/4"	D	HM	MTL	PAINT	A	HM	60 MIN.				INSULATED, SEE NOTES 5, 7
464	PR 3'-0" x 7'-0" x 1 3/4"	A	SC	WD	PAINT	A	HM	20 MIN.				SEE NOTES 1,3,5
465	PR 3'-0" x 7'-0" x 1 3/4"	A	SC	WD	PAINT	A	HM	20 MIN.				SEE NOTES 1,3,5


**NOTES:**

- DOOR FINISHES ARE THERMAL FUSED FLUSH DOOR FACES, PRE-FINISHED COLOR PER OWNER.
- BATHROOM DOOR TO HAVE A PRIVACY LOCK THAT WILL UNLOCK IF CLOSED IN THE LOCKED POSITION.
- PROVIDE DOOR SWEEP DHSI #36xAMU-3.
- SUPPLY BALL AND LOOP INTERIOR LOCK.
- RATED DOORS WITH SELF CLOSER AND SEALS SHALL BE IN ACCORDANCE WITH NFPA 80 AND NFPA 105.
- INSULATE INSIDE OF METAL DOOR JAMB.
- PROVIDE EXTERIOR METAL DOOR THRESHOLD.

**DOOR SCHEDULE ABBREVIATION:**

FIN	FINISH	MAT	MATERIAL	PR	PAIR
GRP	GROUP	MT	METAL	SC	SOLID CORE
HDW	HARDWARE	MR	MIRROR	WD	WOOD
HM					



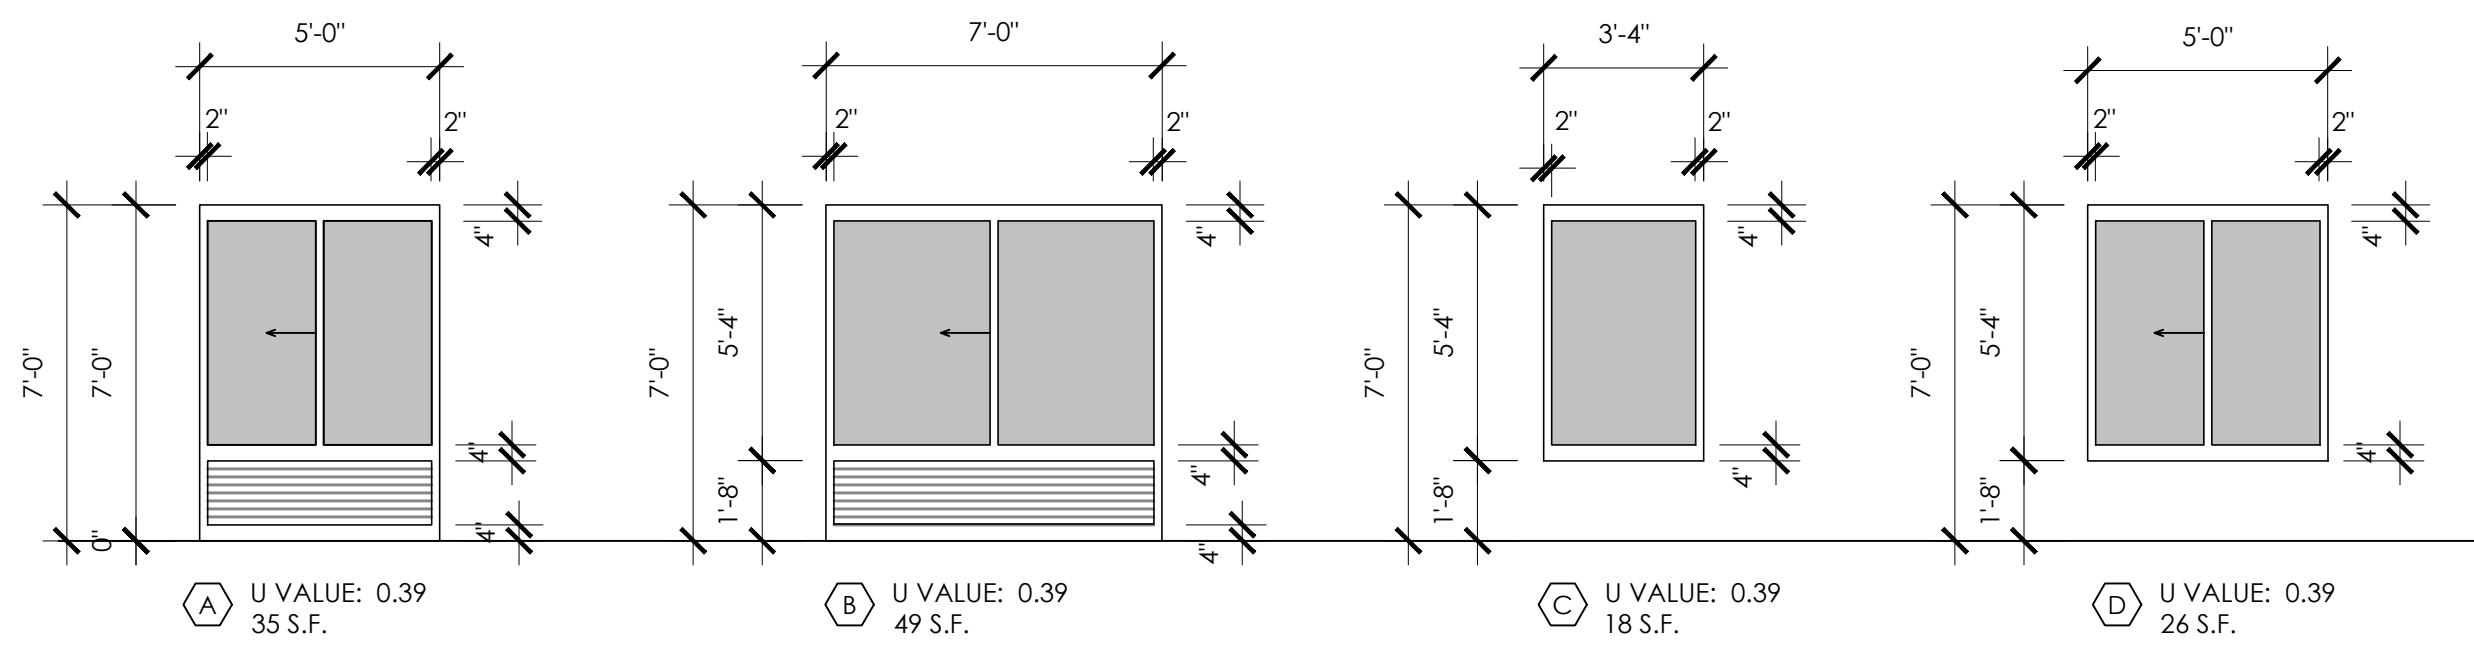


GLAZING		
EXTERIOR WALL AREA:	11,094 S.F.	
VERTICAL + OVERHEAD GLAZING:	1,884 S.F.	
% OF GLAZING	17 %	
PROJECTION FACTOR		
ELEVATION	'A'	'B'
NORTH STAIRWELL	1.58	14.5
NORTH	.375	10.91/A
SOUTH	.375	10.91/A
WEST	.375	10.91/A
PF		
		.109
		.034
		.034
		.034
THESE MEASUREMENTS SHOW THE BEST AVAILABLE PF AT THE 4TH FLOOR. ALL ARE BELOW 0.2. THE NUMBERS DECREASE AT THE 3RD AND 2ND FLOORS.		

- FENESTRATION NOTES**
1. ALL WINDOWS TO MEET MINIMUM 0.39 U-VALUE.
  2. ALL WINDOWS TO MEET .40 SHGC.
  3. ALL WINDOWS TO BEAR MANUFACTURER'S CERTIFIED LABEL.
  4. ALL WINDOWS TO BE FILLED WITH ARGON GAS.
  5. ALL WINDOWS TO HAVE AN EMISSIVITY OF .15 TO .08.
  6. ALL WINDOWS WITH TEMPERED GLAZING TO BEAR THE ETCHED LABEL.

WSEC FENESTRATION REQUIREMENTS									
TYPE	MATERIAL	U-FACTOR	DIRECTION	PROJ. FACTOR	T C402.4 SHGC	T C303.1.3(3) V1 CLEAR/TINTED	NO. OF UNITS	AREA	TOTAL AREA
A	ALUM	.39	N	<.20	.53	.60/.30	3	35 SF	105 SF
A	ALUM	.39	E	<.20	.40	.60/.30	21	35 SF	735 SF
A	ALUM	.39	S	<.20	.40	.60/.30	3	35 SF	105 SF
B	ALUM	.39	E	<.20	.40	.60/.30	3	49 SF	147 SF
C	ALUM	.39	N	<.20	.53	.60/.30	3	18 SF	54 SF
D	ALUM	.39	N	<.20	.53	.60/.30	6	26 SF	156 SF
D	ALUM	.39	E	<.20	.40	.60/.30	3	26 SF	78 SF
D	ALUM	.39	W	<.20	.40	.60/.30	18	26 SF	504 SF
								TOTAL	1,884 SF

12202 Pacific Ave. Suite C  
Tacoma, Washington 98444  
P: 253.531.4300 F: 253.537.6542  
E: architects@austincina.com


**1 WINDOW TYPES**  
24 x 36 - 1/4" = 1'-0"  
12 x 18 - 1/8" = 1'-0"

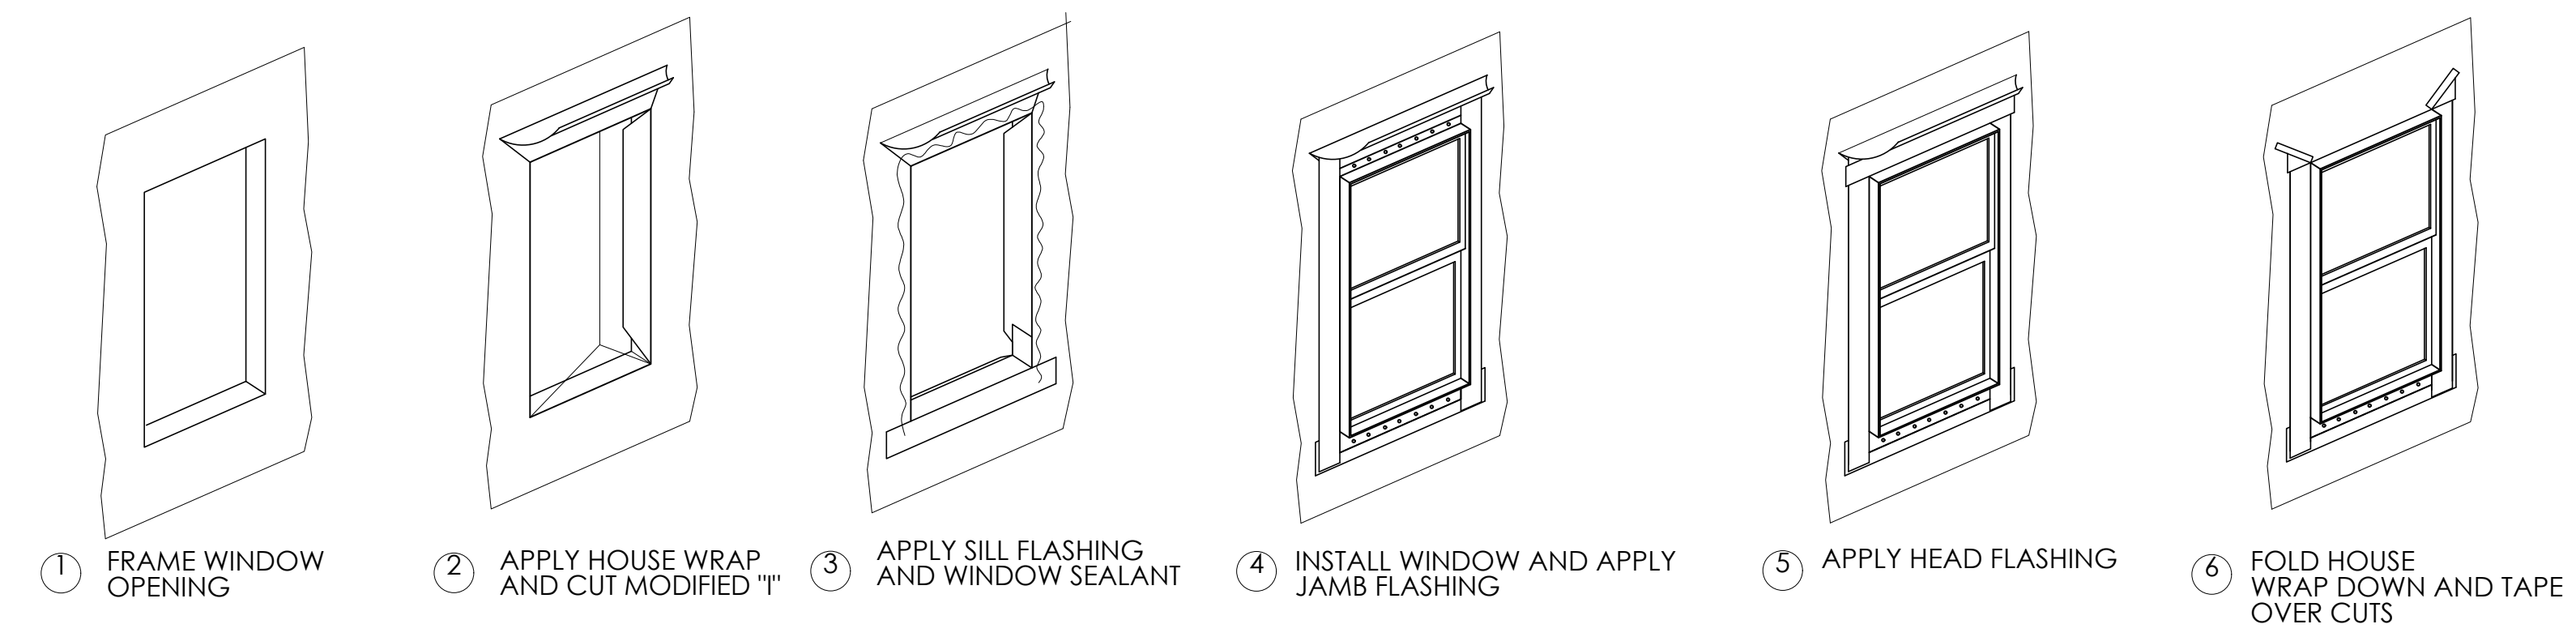

**City of Puyallup**  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

**2 TYP. WINDOW FLASHING APPLICATION**  
24 x 36 - 1/4" = 1'-0"  
12 x 18 - 1/8" = 1'-0"

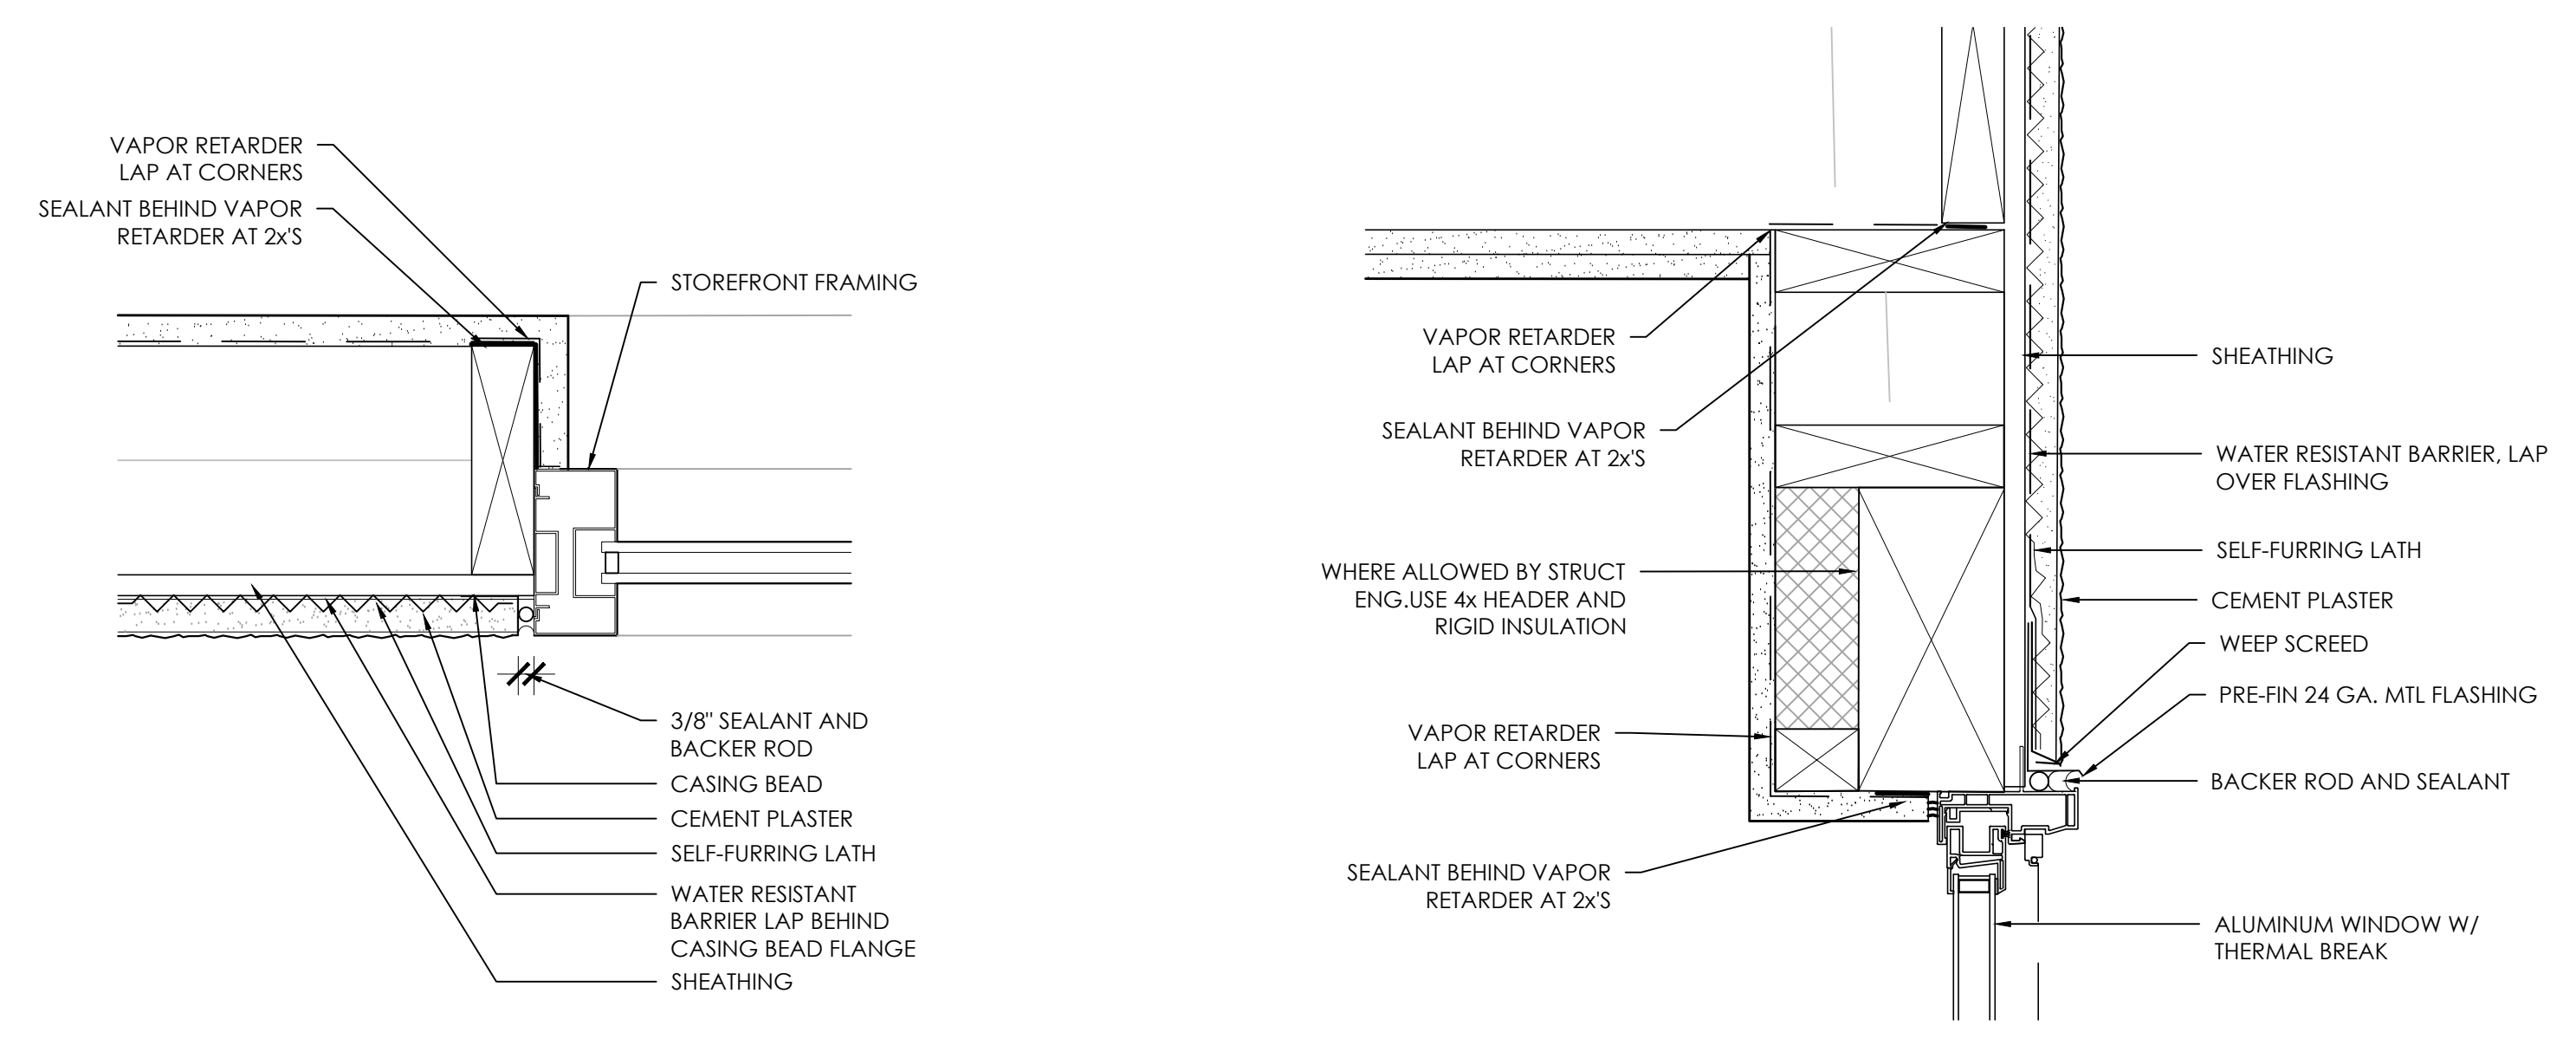


**3 STOREFRONT JAMB**  
24 x 36 - 3" = 1'-0"  
12 x 18 - 1 1/2" = 1'-0"


**4 ALUMINUM WINDOW HEAD**  
24 x 36 - 3" = 1'-0"  
12 x 18 - 1 1/2" = 1'-0"

**WINDOW SCHEDULE**  
Addition to Hampton Inn & Suites  
Hampton Inn & Suites  
1515 S. Meridian, Puyallup, WA


Job #:  
Date: January 6, 2020  
Revs:

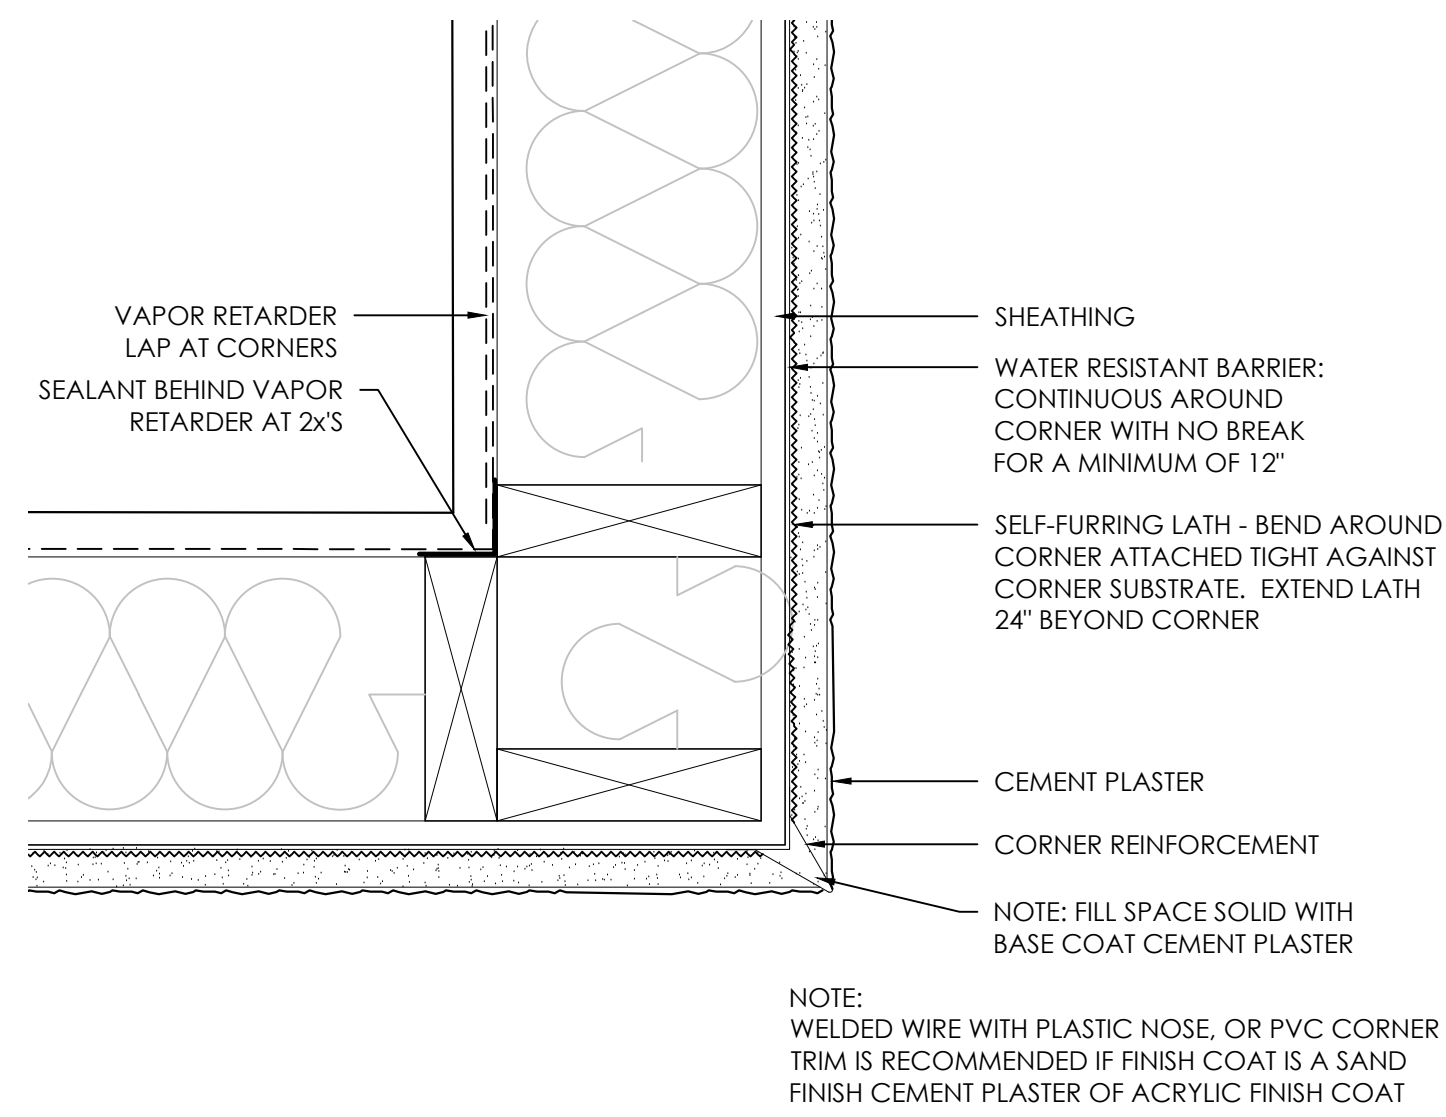


**1** STUCCO OUTSIDE CORNER  
 24" X 36" SCALE 3"= 1'-0"  
 12" X 18" SCALE 1-1/2"= 1'-0"

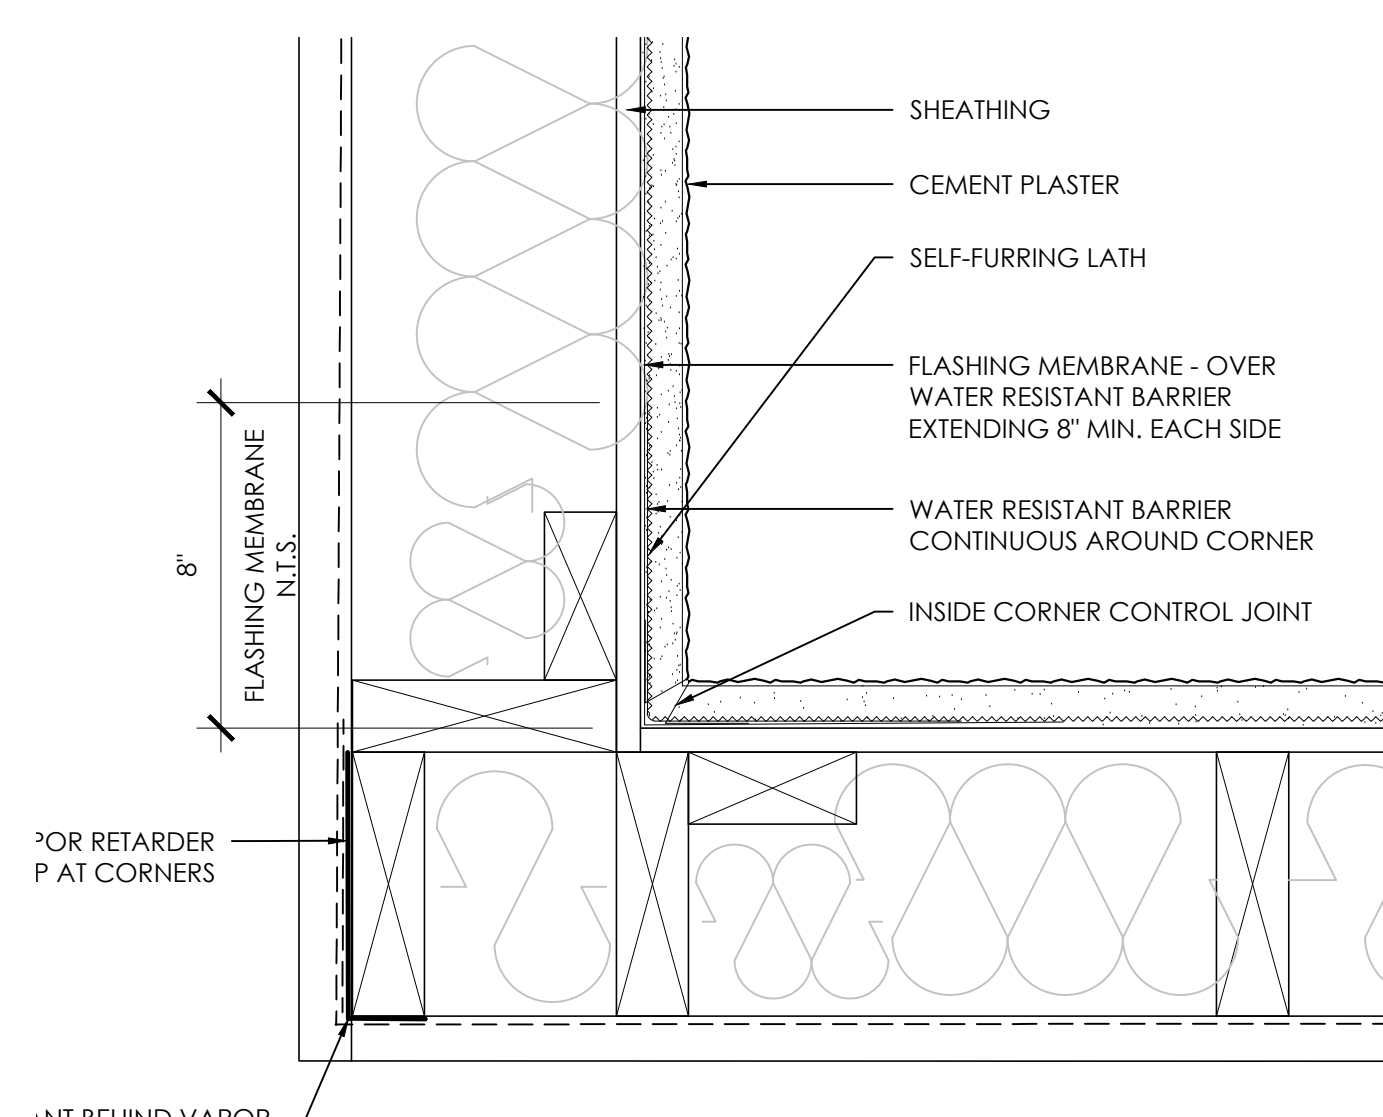


**2** STUCCO INSIDE CORNER  
 24" X 36" SCALE 3"= 1'-0"  
 12" X 18" SCALE 1-1/2"= 1'-0"

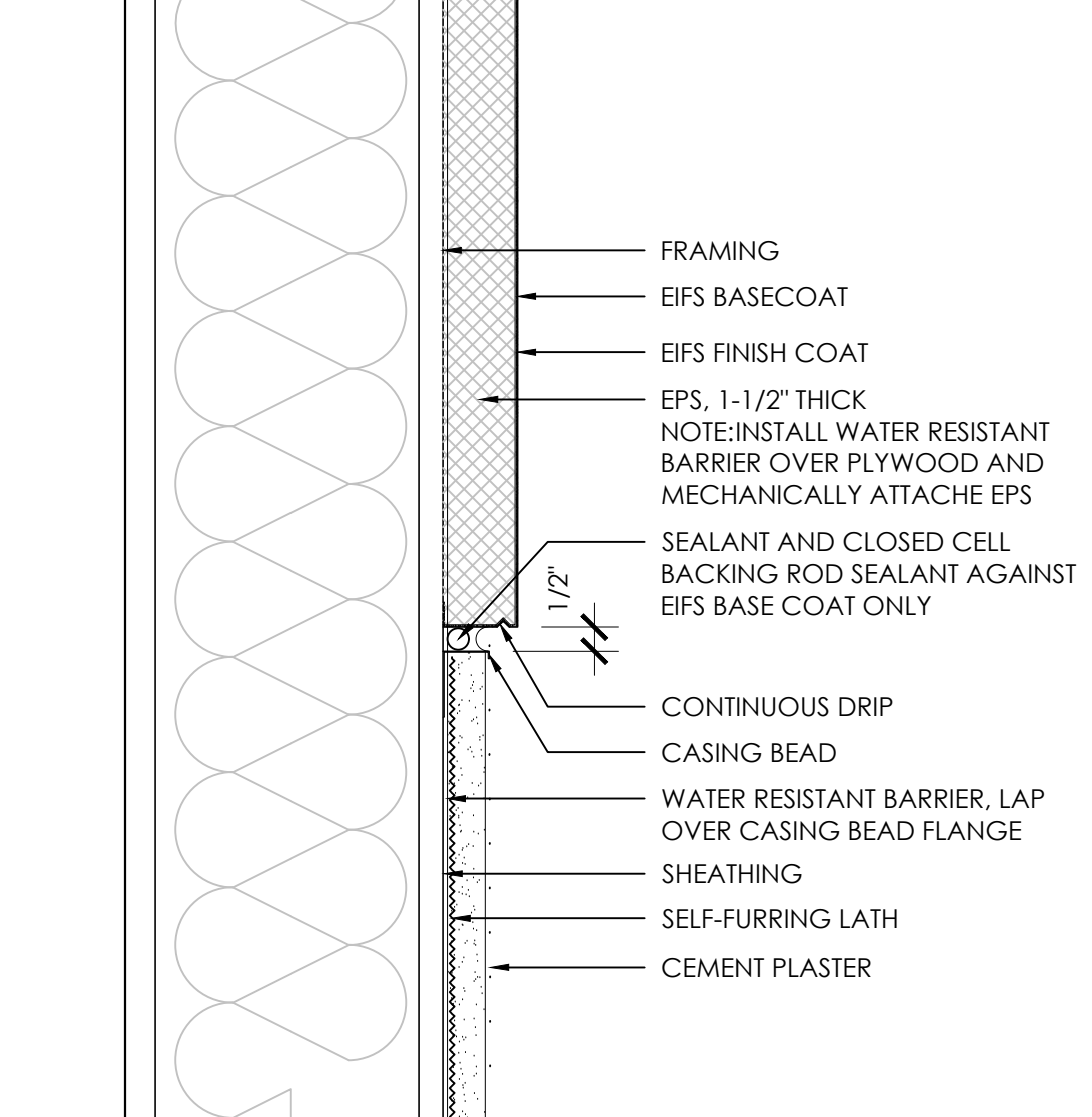


**3** STUCCO-EFS TRANSITION  
 24" X 36" SCALE 3"= 1'-0"  
 12" X 18" SCALE 1-1/2"= 1'-0"

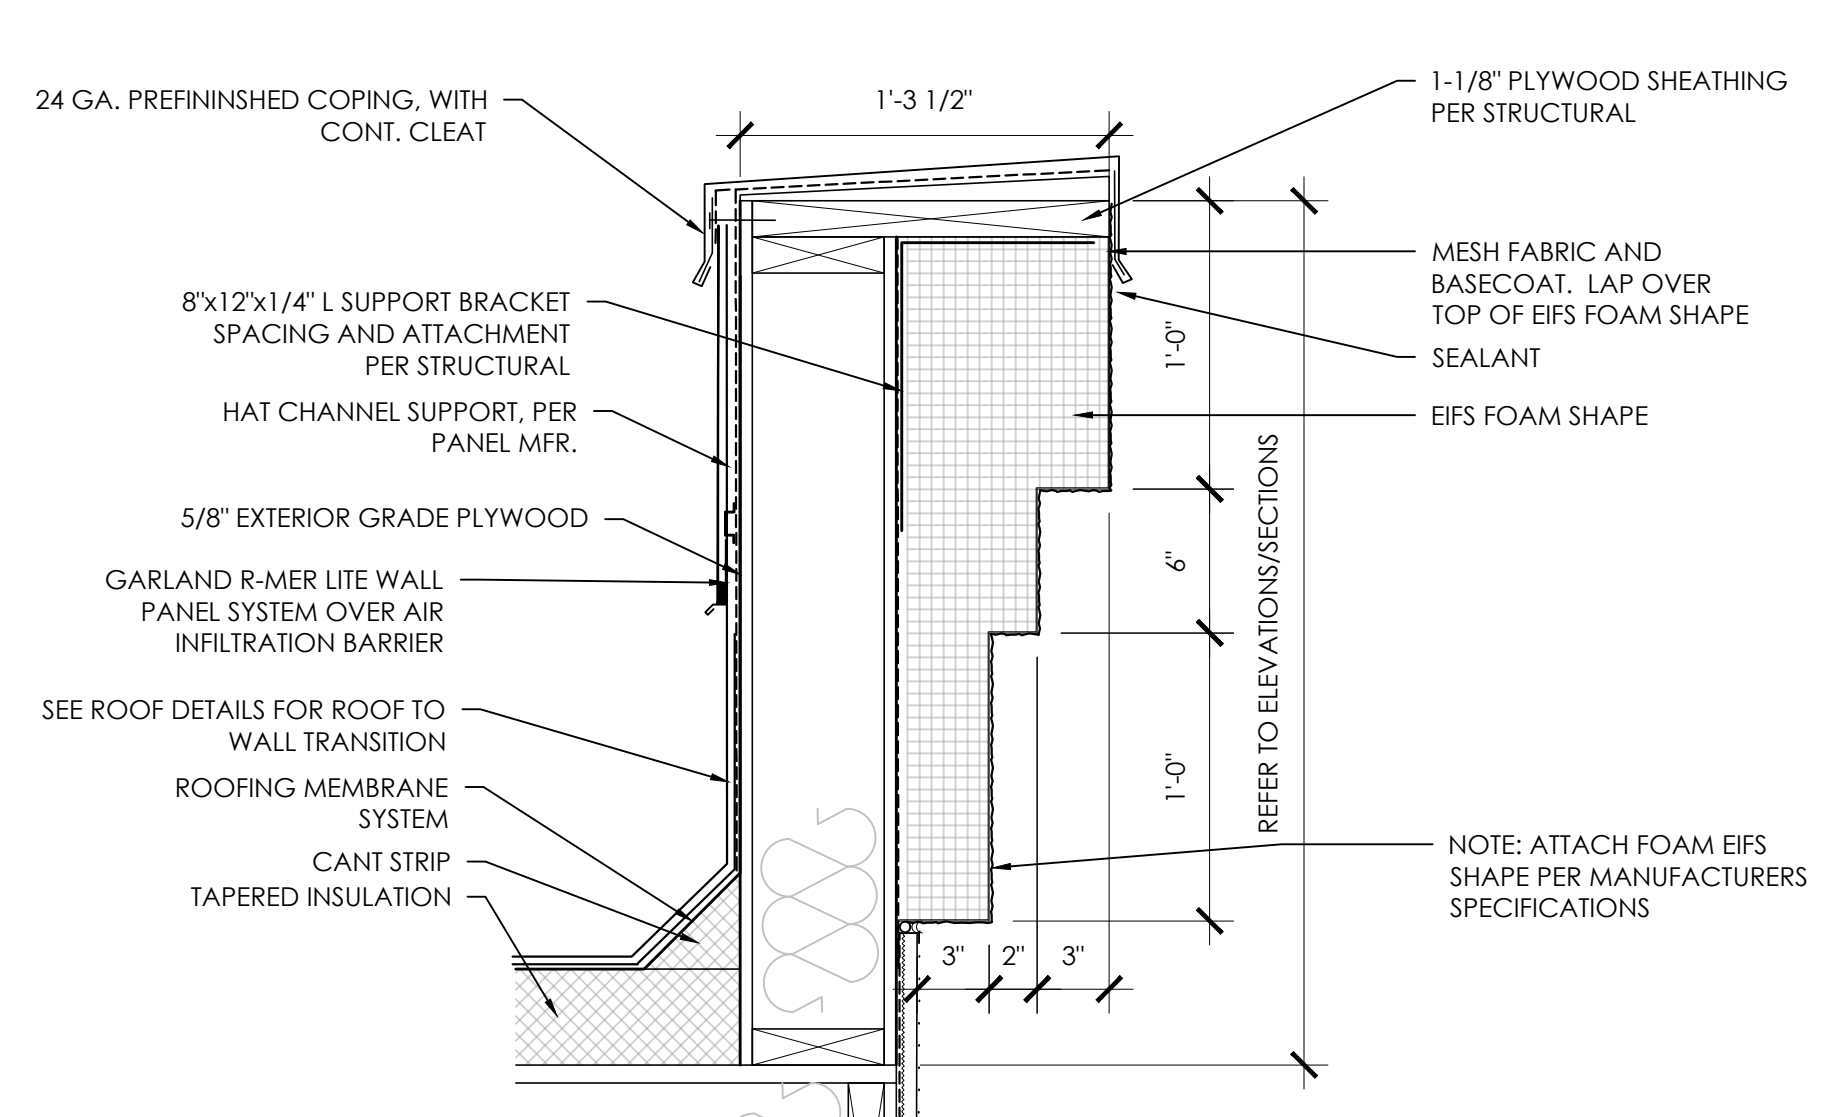


**4** EIFS PARAPET DTL.  
 24" X 36" SCALE 1-1/2"= 1'-0"  
 12" X 18" SCALE 3/4"= 1'-0"

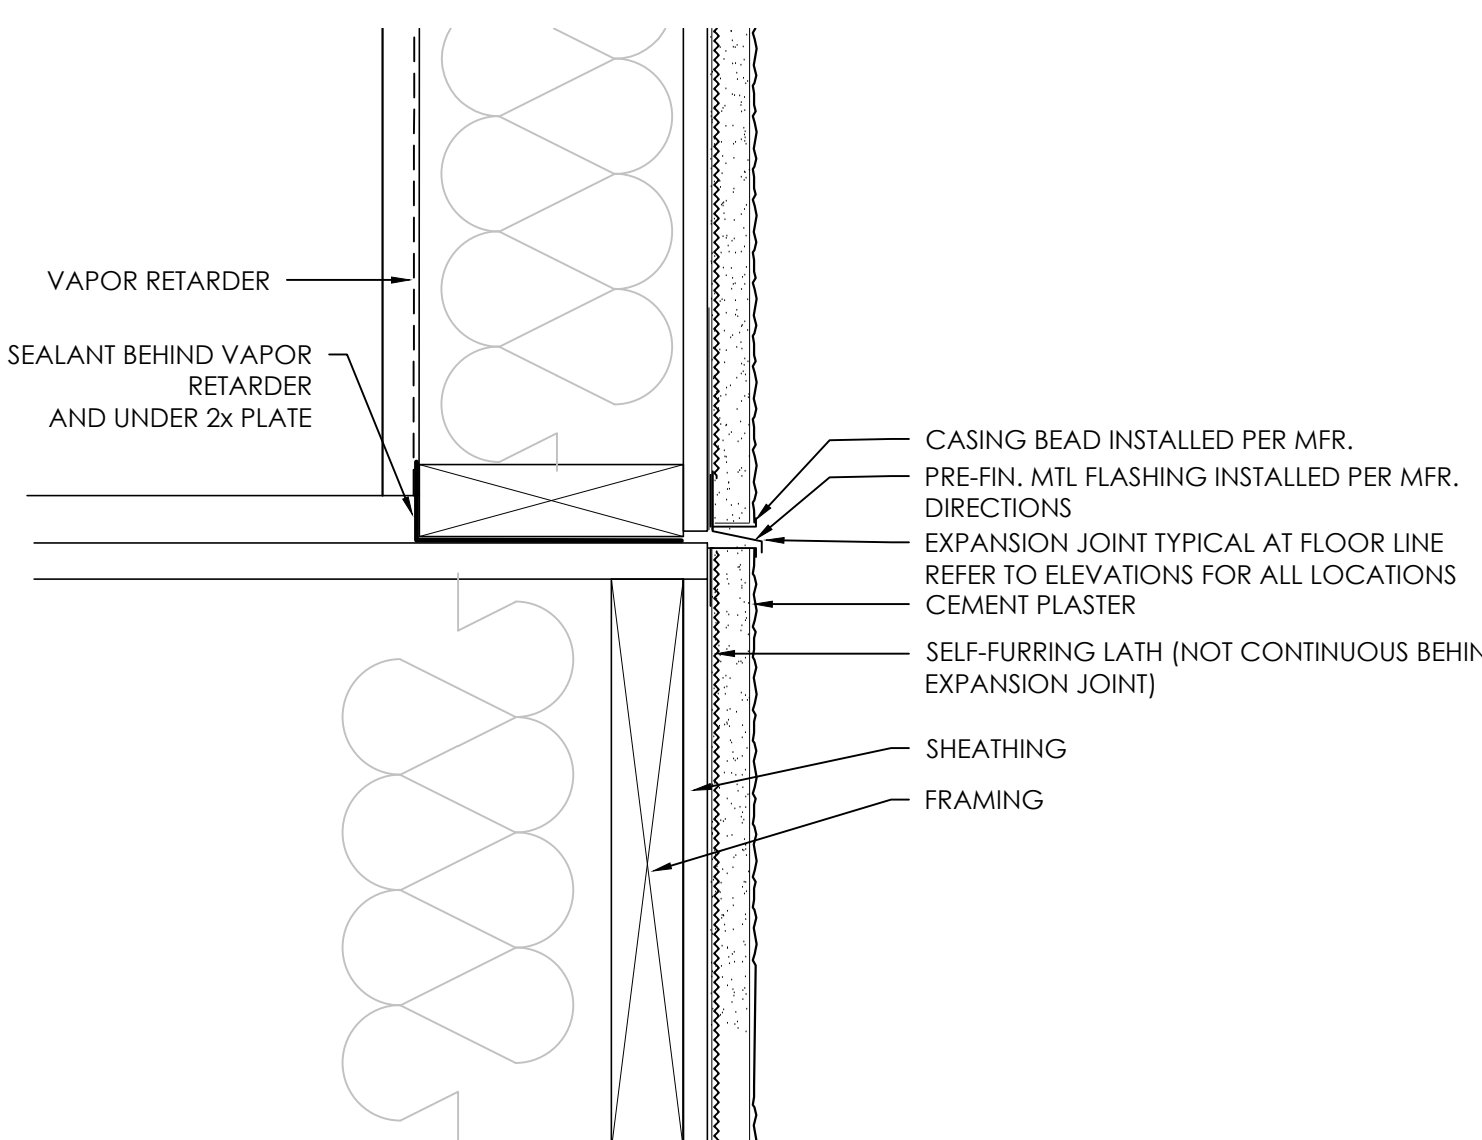


**5** STUCCO CONTROL JOINT  
 24" X 36" SCALE 3"= 1'-0"  
 12" X 18" SCALE 1-1/2"= 1'-0"

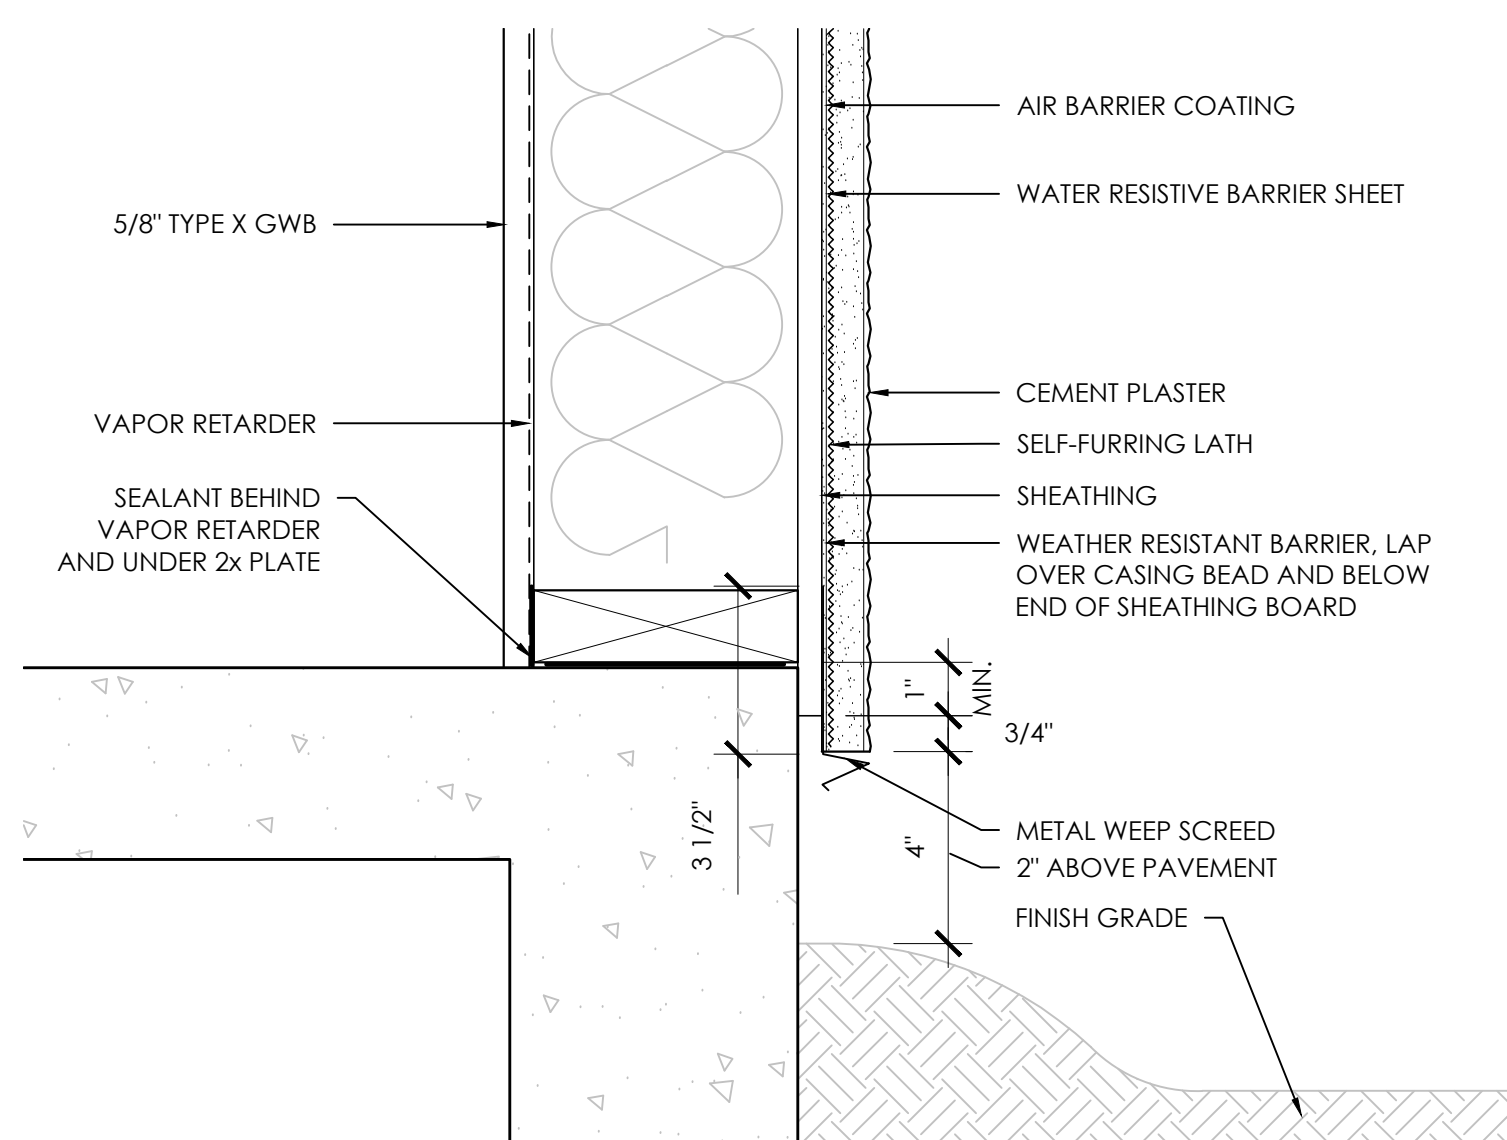


**6** STUCCO DRIP TERMINATION  
 24" X 36" SCALE 3"= 1'-0"  
 12" X 18" SCALE 1-1/2"= 1'-0"

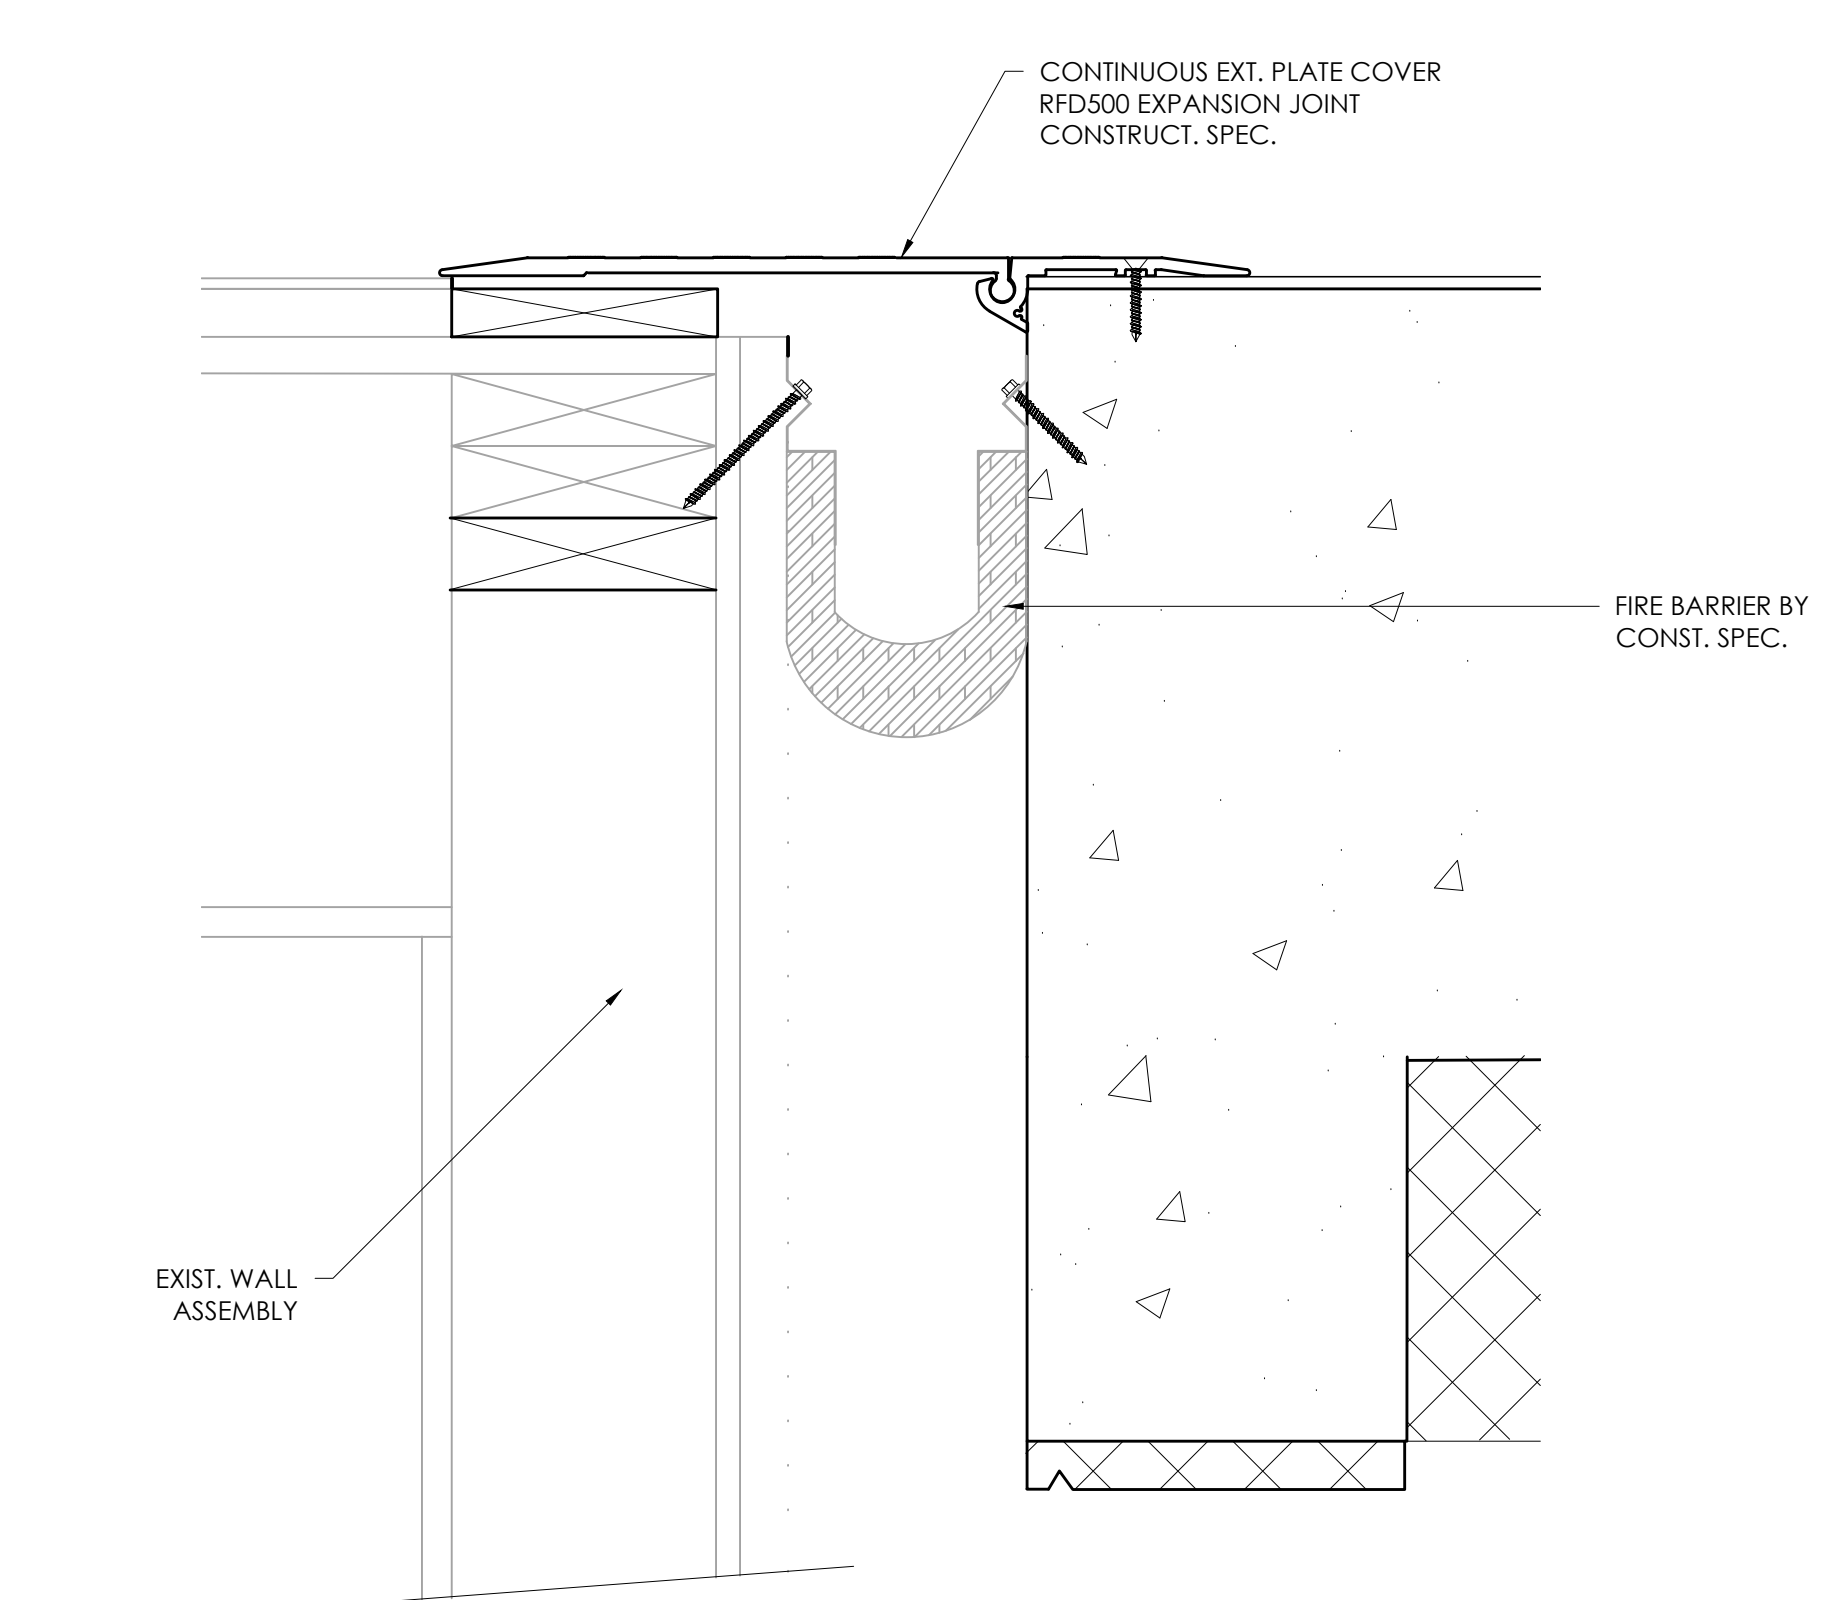

**9** SEISMIC EXPANSION JOINT @ FLOOR  
 24" X 36" SCALE 3"= 1'-0"  
 12" X 18" SCALE 1-1/2"= 1'-0"

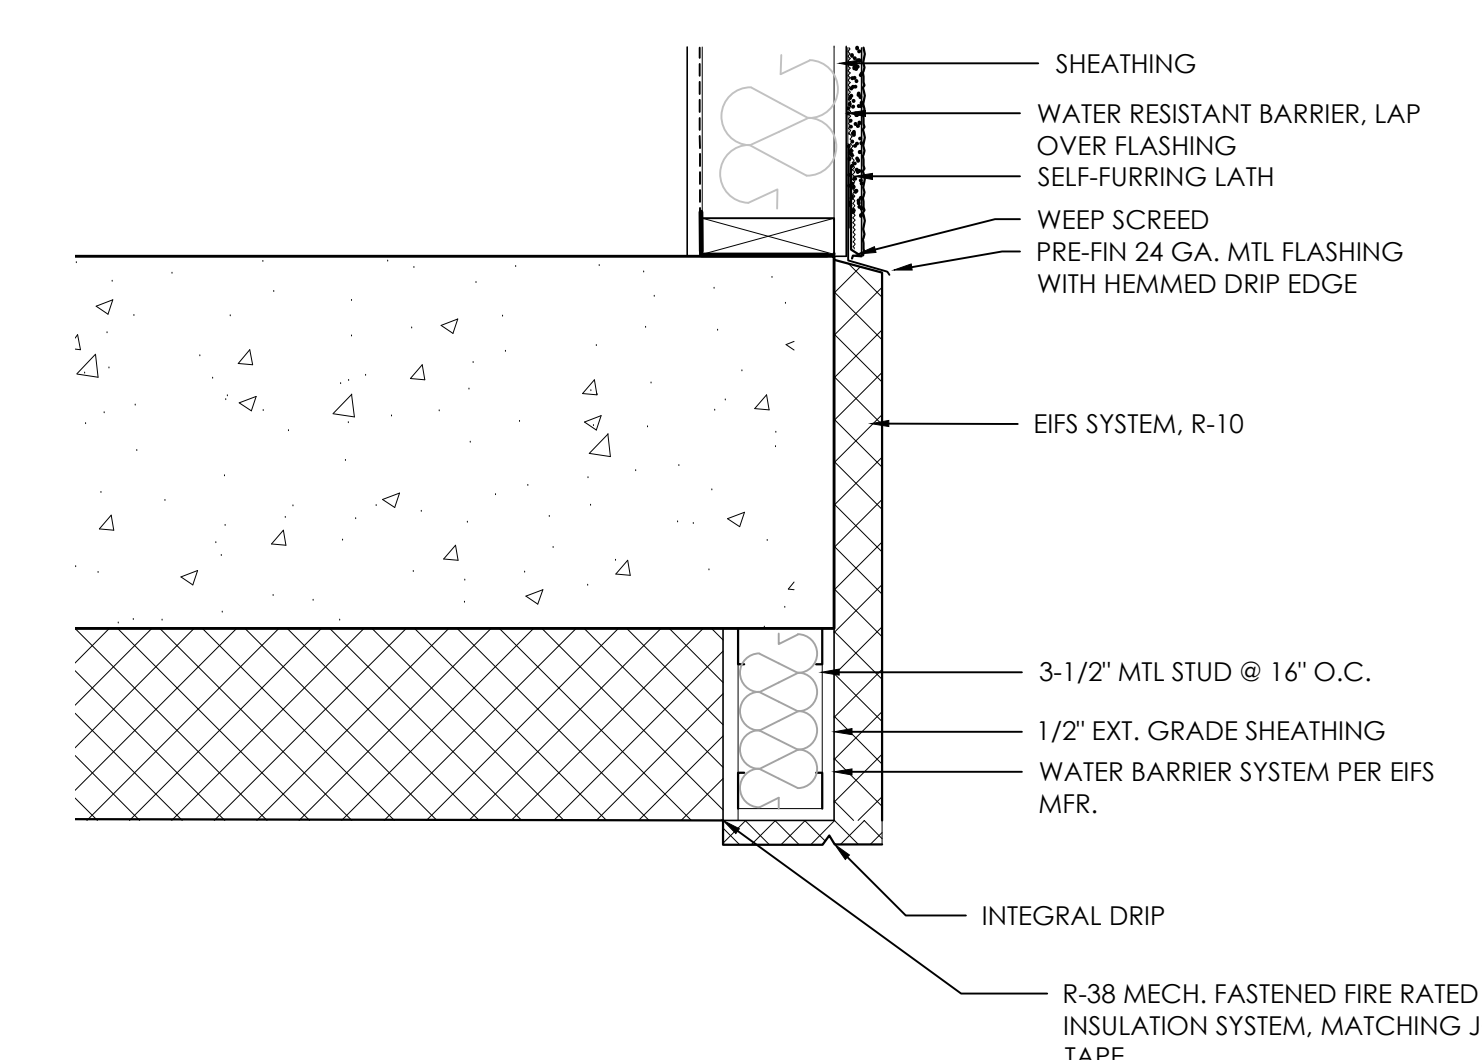


**7** STUCCO DRIP @ OVER PARKING  
 24" X 36" SCALE 1-1/2"= 1'-0"  
 12" X 18" SCALE 3/4"= 1'-0"

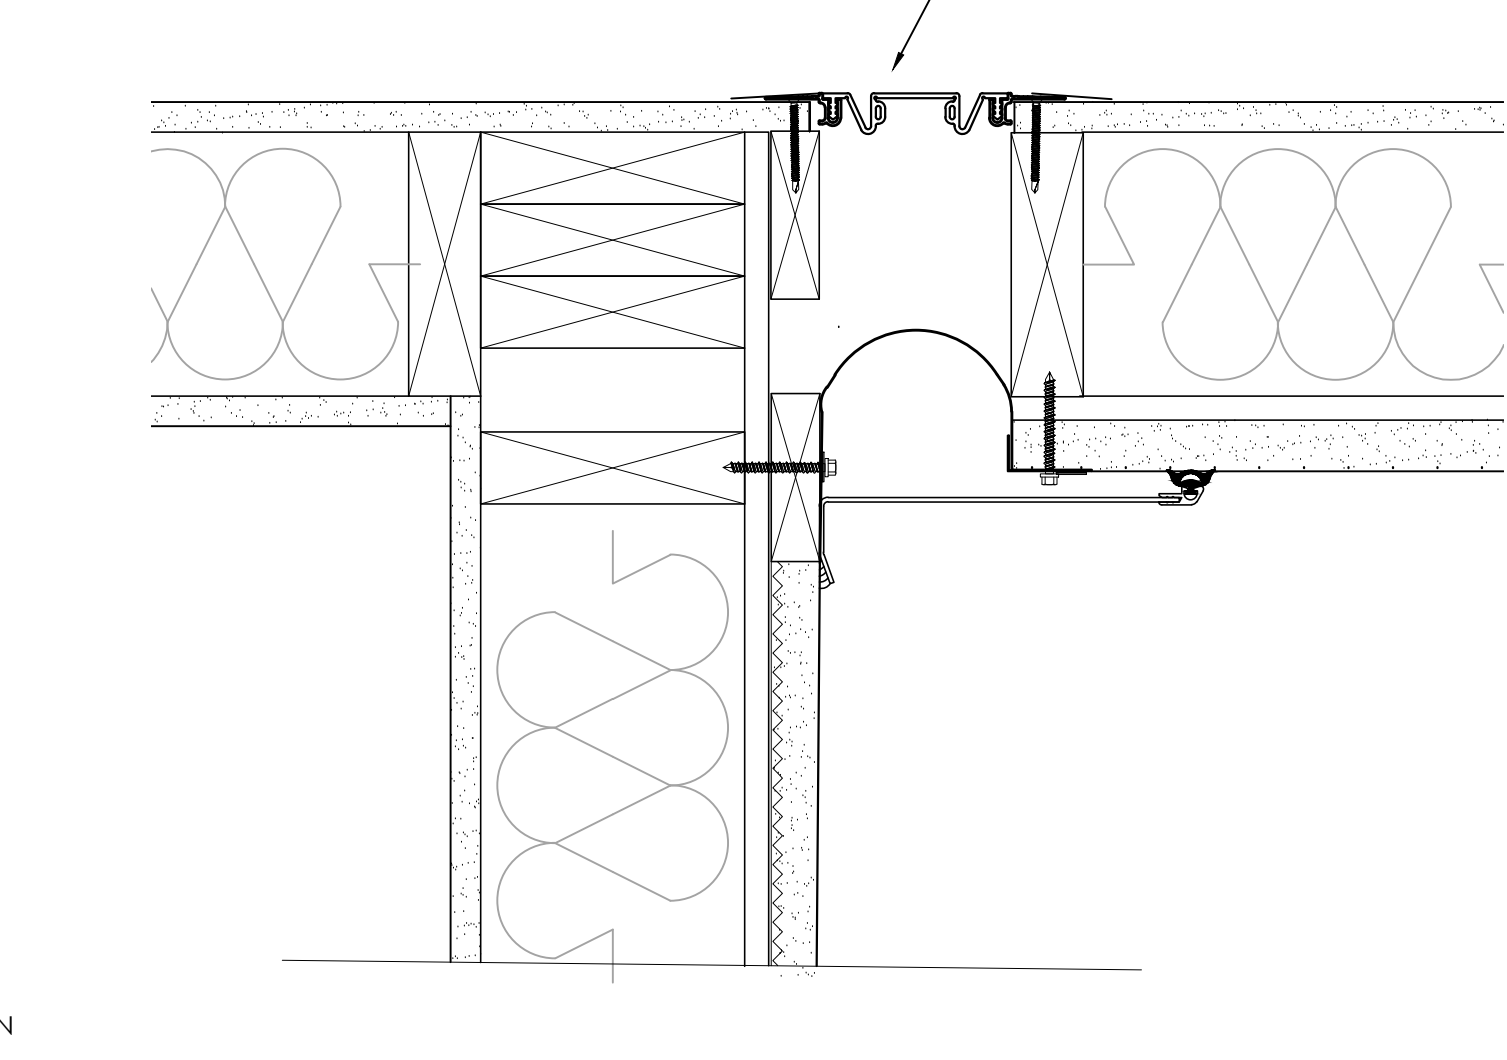

**8** STUCCO EXPANSION JOINT  
 24" X 36" SCALE 3"= 1'-0"  
 12" X 18" SCALE 1-1/2"= 1'-0"



12202 Pacific Ave. Suite C  
 Tacoma, Washington 98444  
 P: 253.531.4300 F: 253.537.6542  
 E: architects@austincina.com

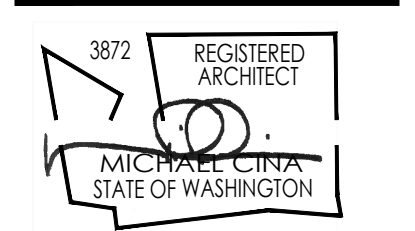


**City of Puyallup**  
 Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic


EXTERIOR DETAILS  
 Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA

Job #:  
 Date: January 6, 2020  
 Revs:

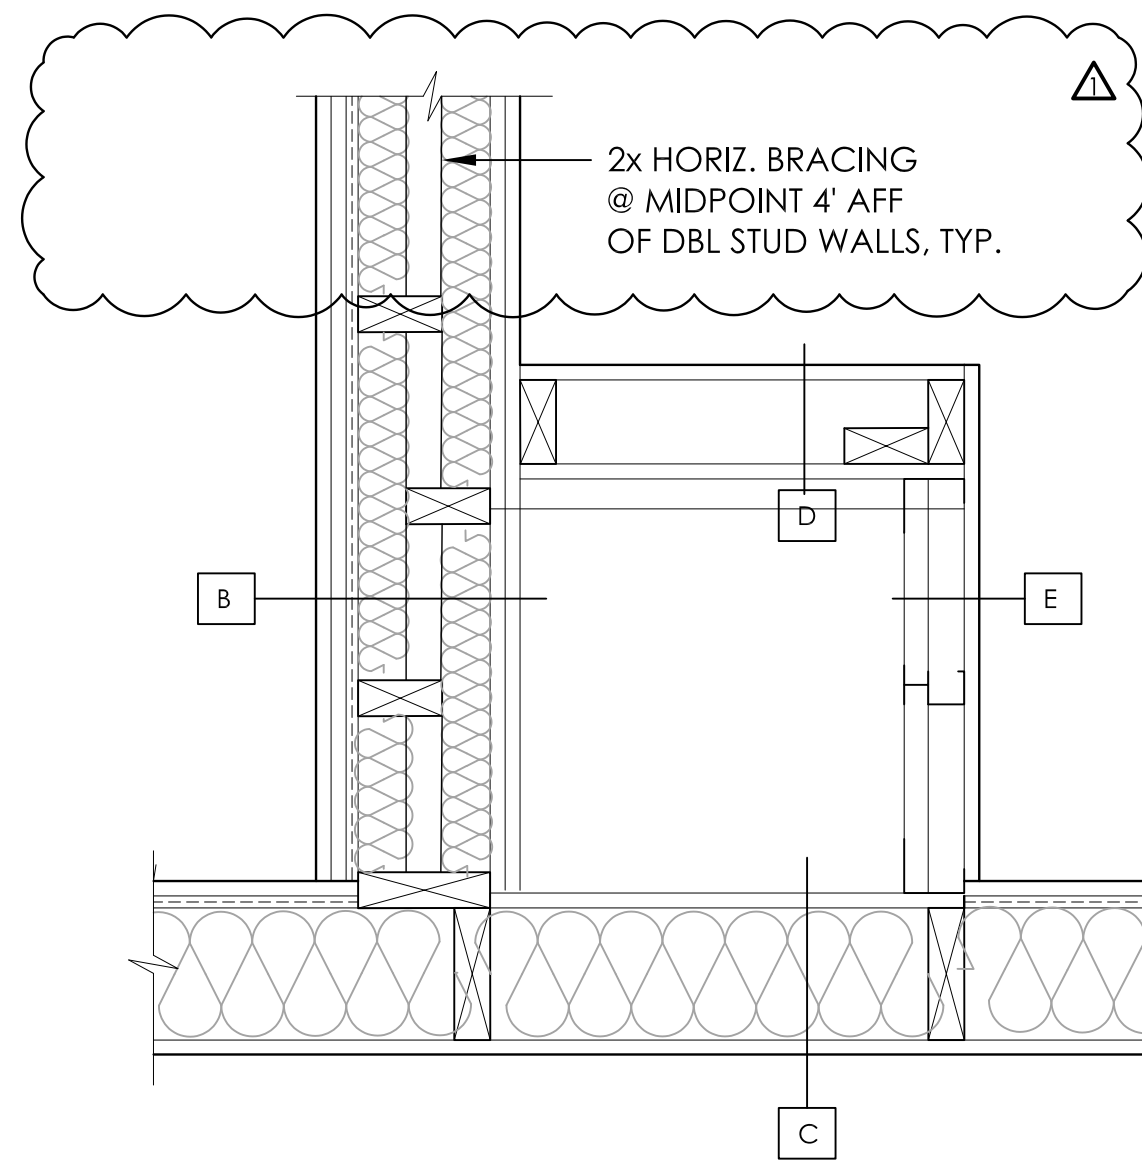


FOR WALL CONSTRUCTION CALL OUTS  
SEE SHEET A0.3 WALL TYPES


**1** SHAFT WALL DTL.  
24x36 - 1-1/2" = 1'-0"  
12x18 - 3/4" = 1'-0"

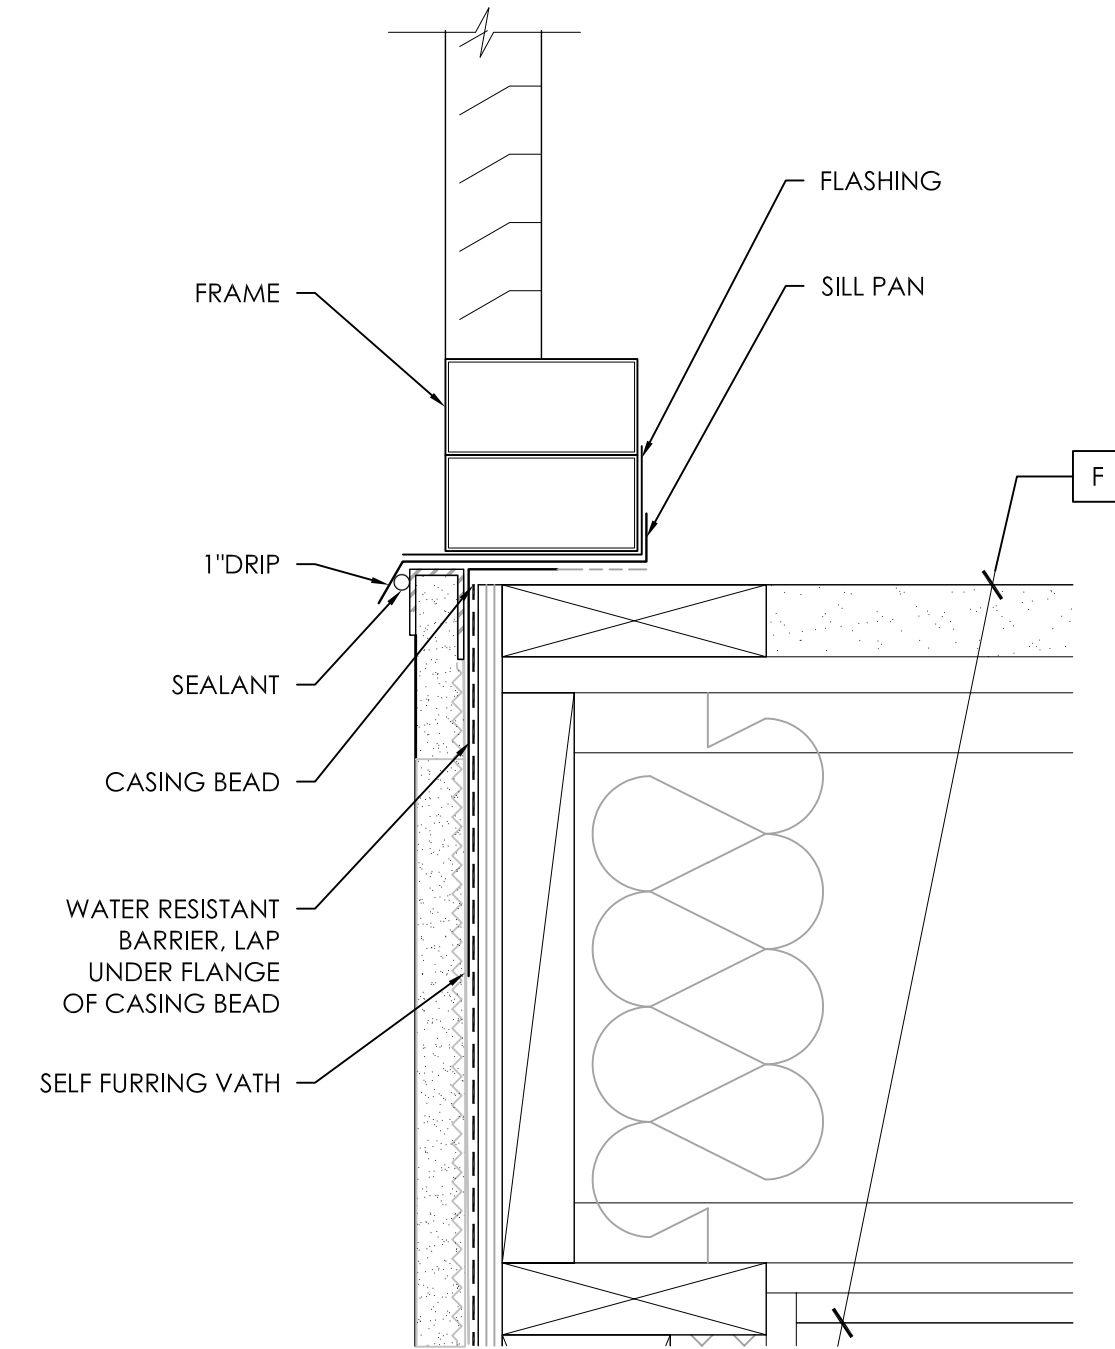

**2** UNIT VENT SILL DTL.  
24x36 - 3" = 1'-0"  
12x18 - 1 1/2" = 1'-0"

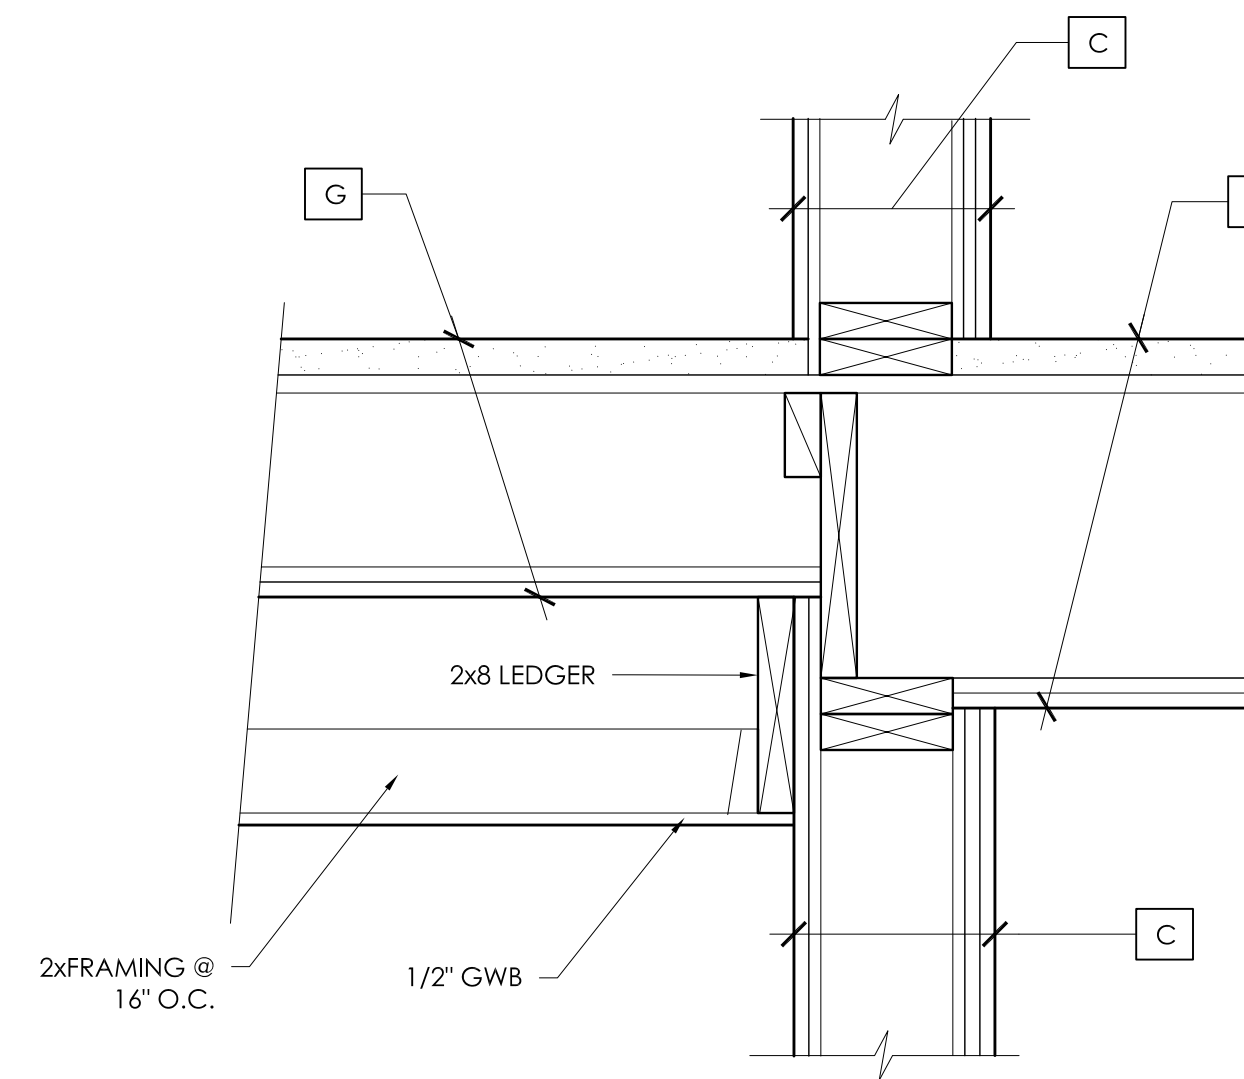


**3** CORRIDOR SOFFIT DTL.  
24x36 - 1-1/2" = 1'-0"  
12x18 - 3" = 1'-0"

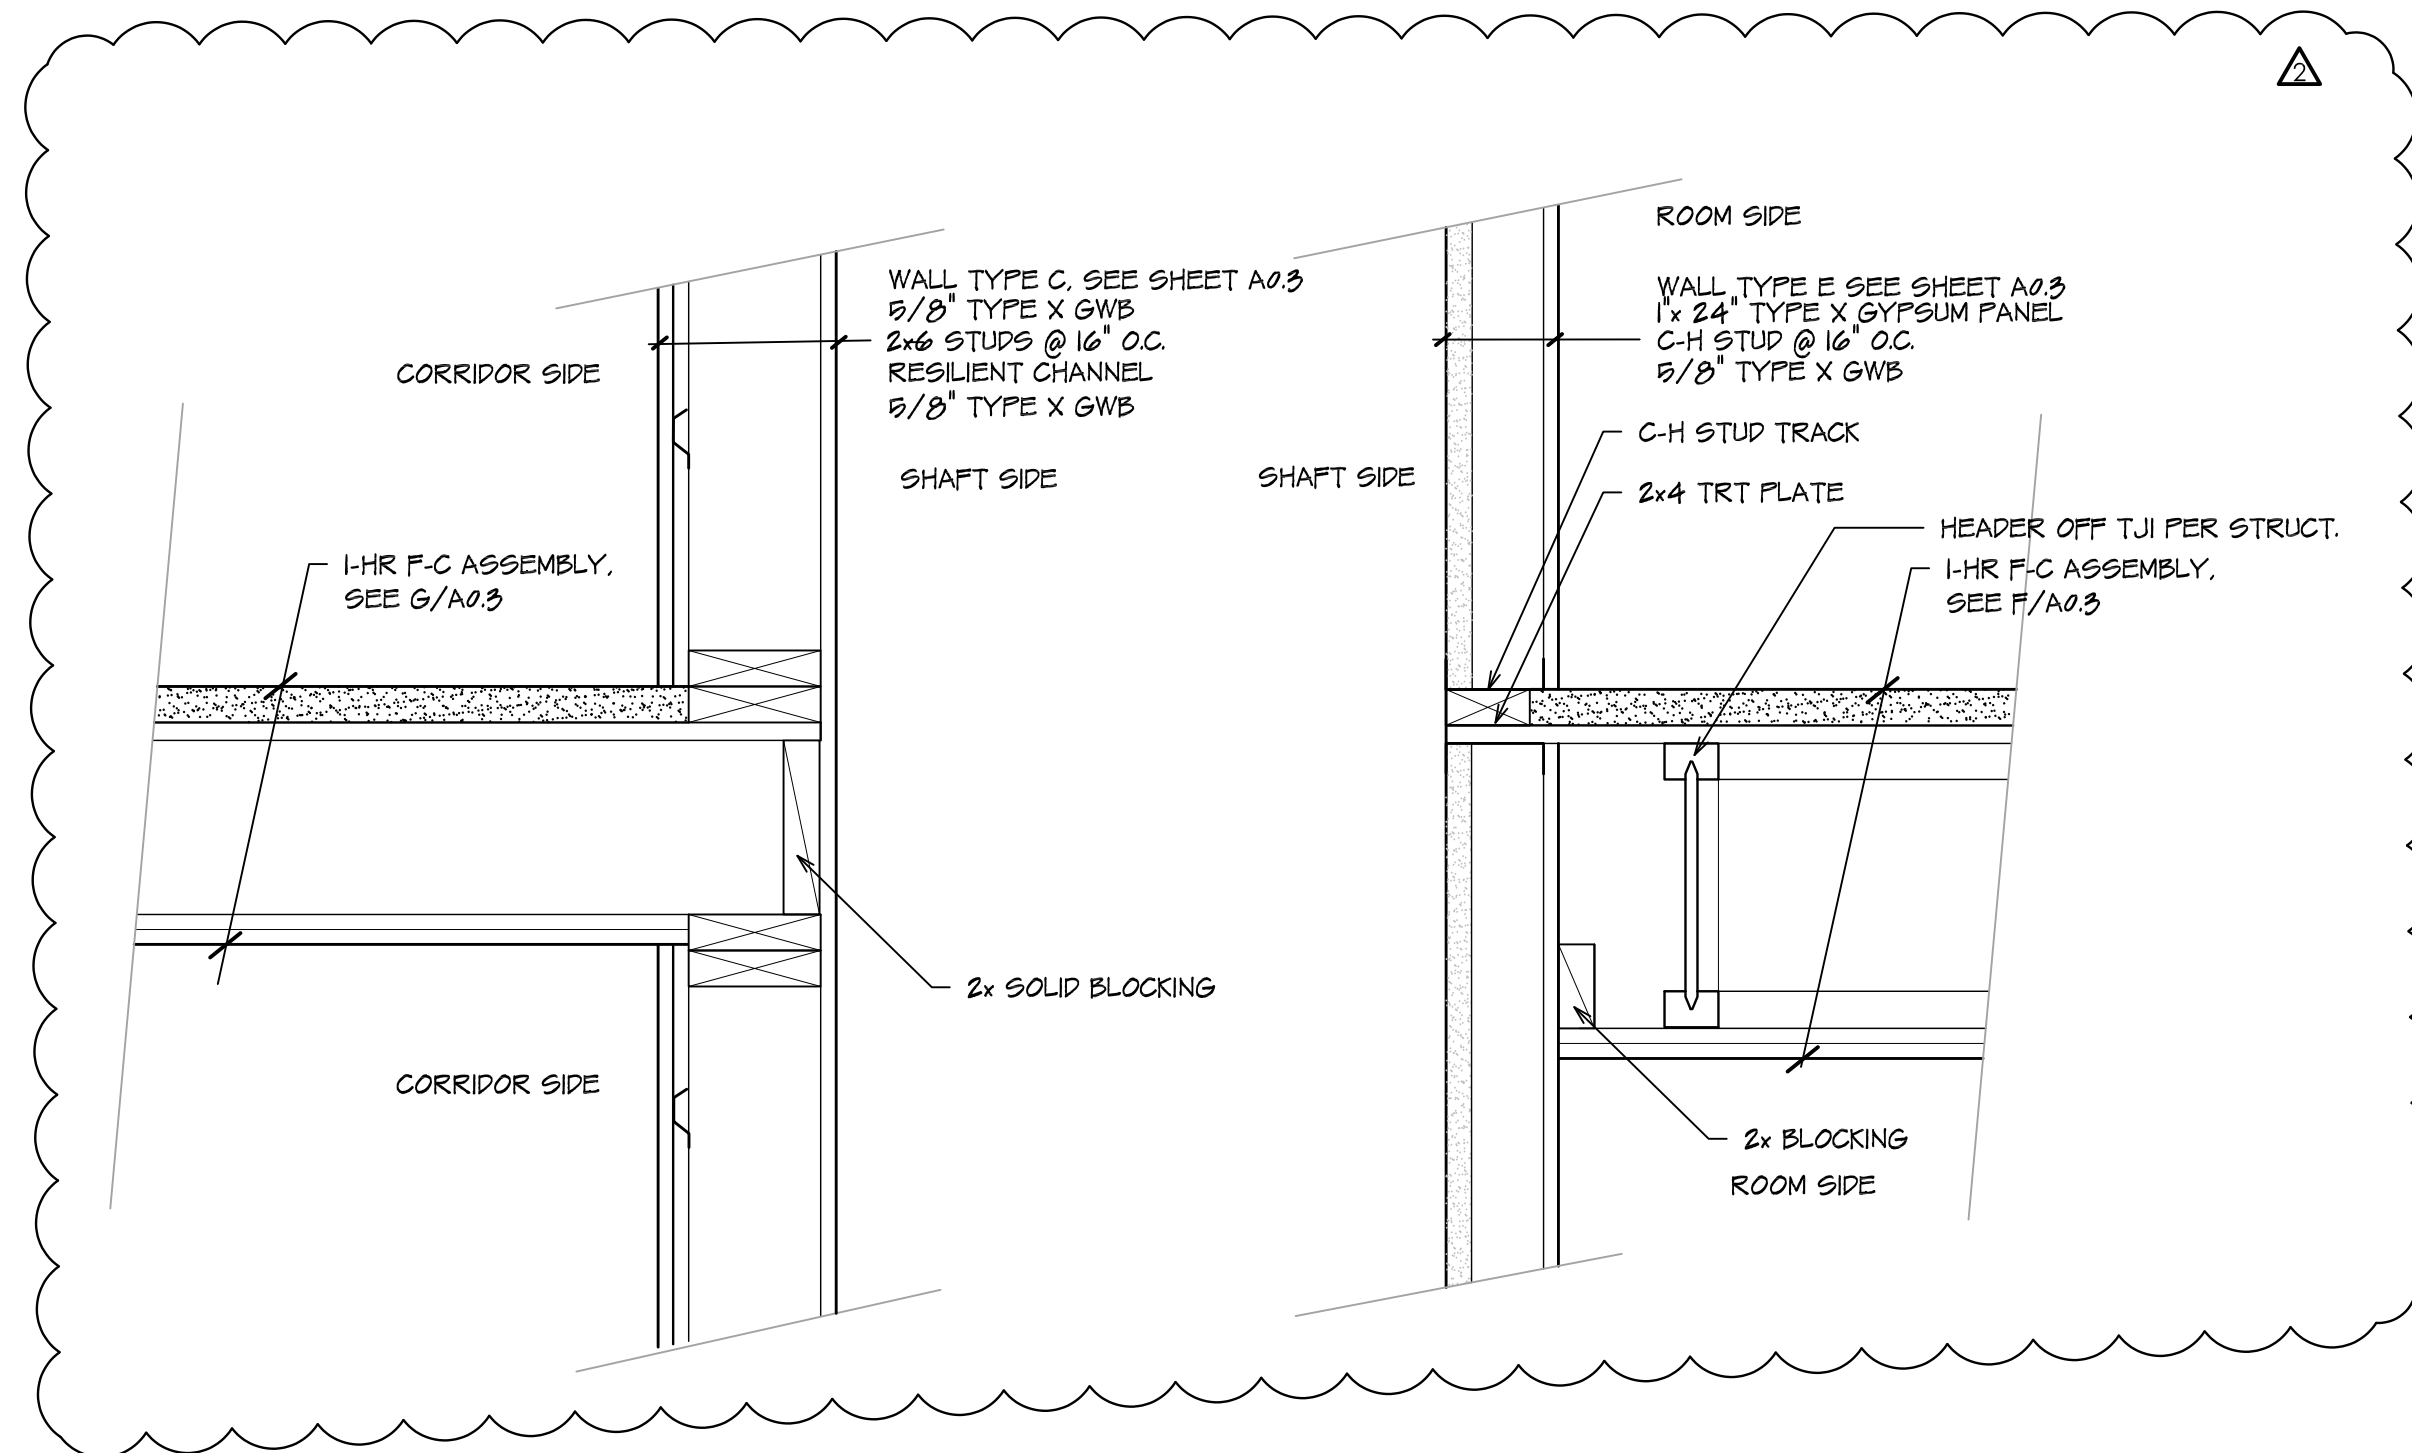

**4** SHAFT WALL DTL.- VERT.  
24x36 - 1-1/2" = 1'-0"  
12x18 - 3/4" = 1'-0"



12202 Pacific Ave. Suite C  
Tacoma, Washington 98444  
P: 253.531.4300 F: 253.537.6542  
E: architects@austincina.com



RESPONSE TO PLAN REVIEW  
COMMENTS 03/03/20  
RESPONSE TO VOICE MAIL  
ENQUIRY 07/26/20


**City of Puyallup**  
Development & Permitting Services  
**ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

DETAILS


Addition to Hampton Inn & Suites  
Hampton Inn & Suites  
1515 S. Meridian, Puyallup, WA

Job #: January 6, 2020  
Date:  
Revs: MARCH 3, 2020  
JULY 29, 2020

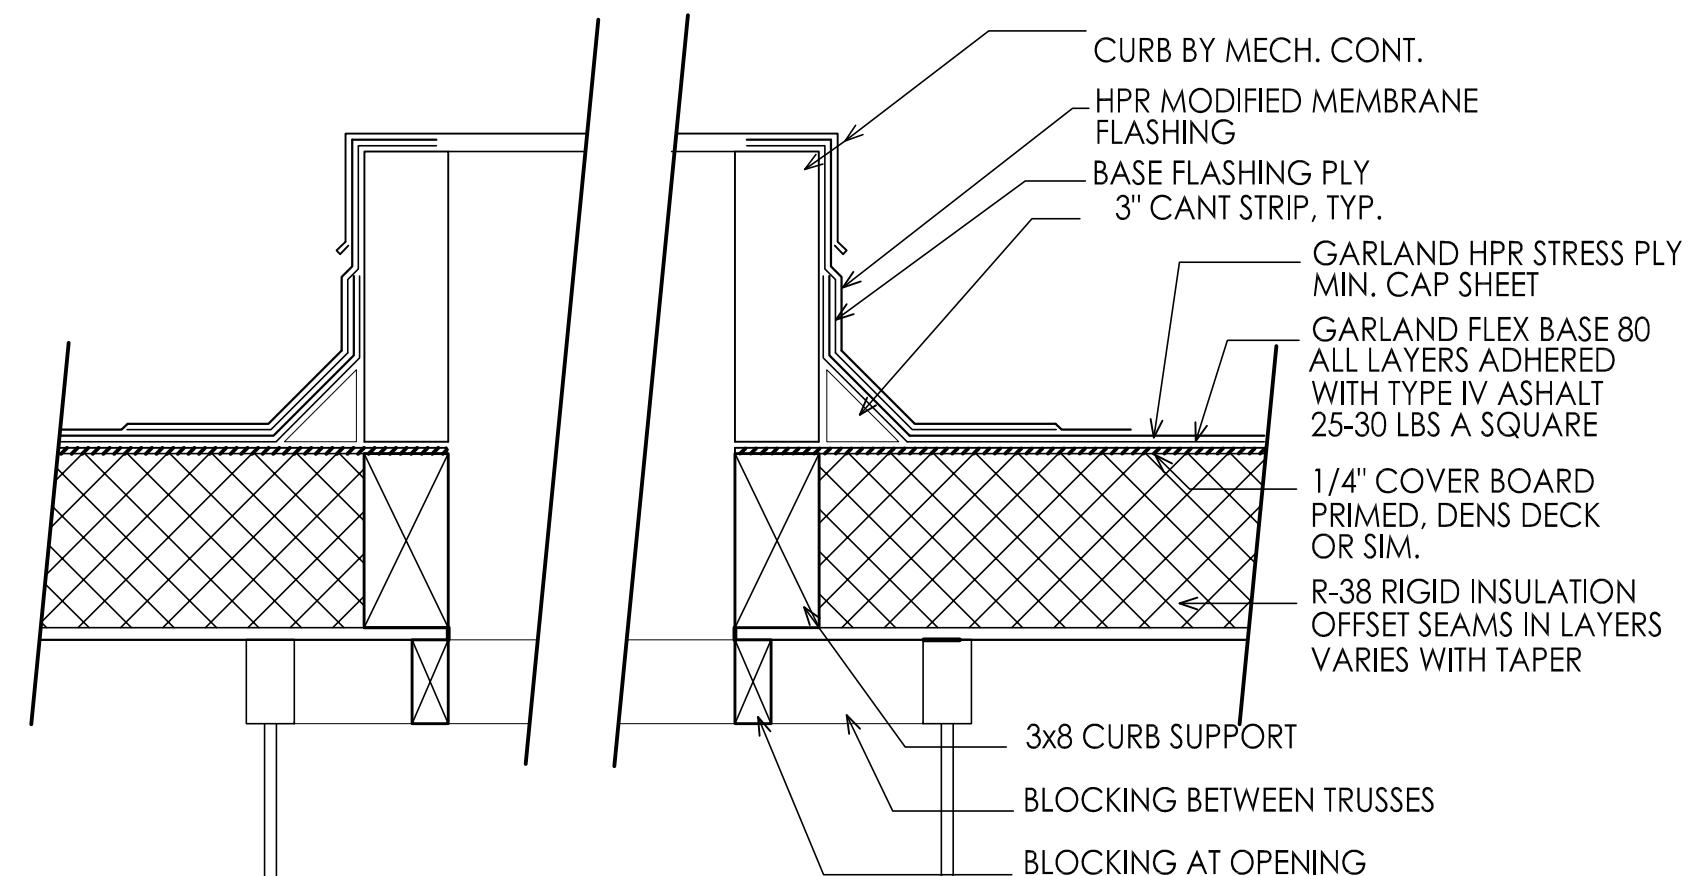


NOTE: COMPLY WITH GARLAND COMPANY STANDARD DETAILS AND MFR. REQUIREMENTS


1 MECH. CURB DTL.  
 24x36 - 1 1/2" = 1'-0"  
 12x18 - 3/4" = 1'-0"

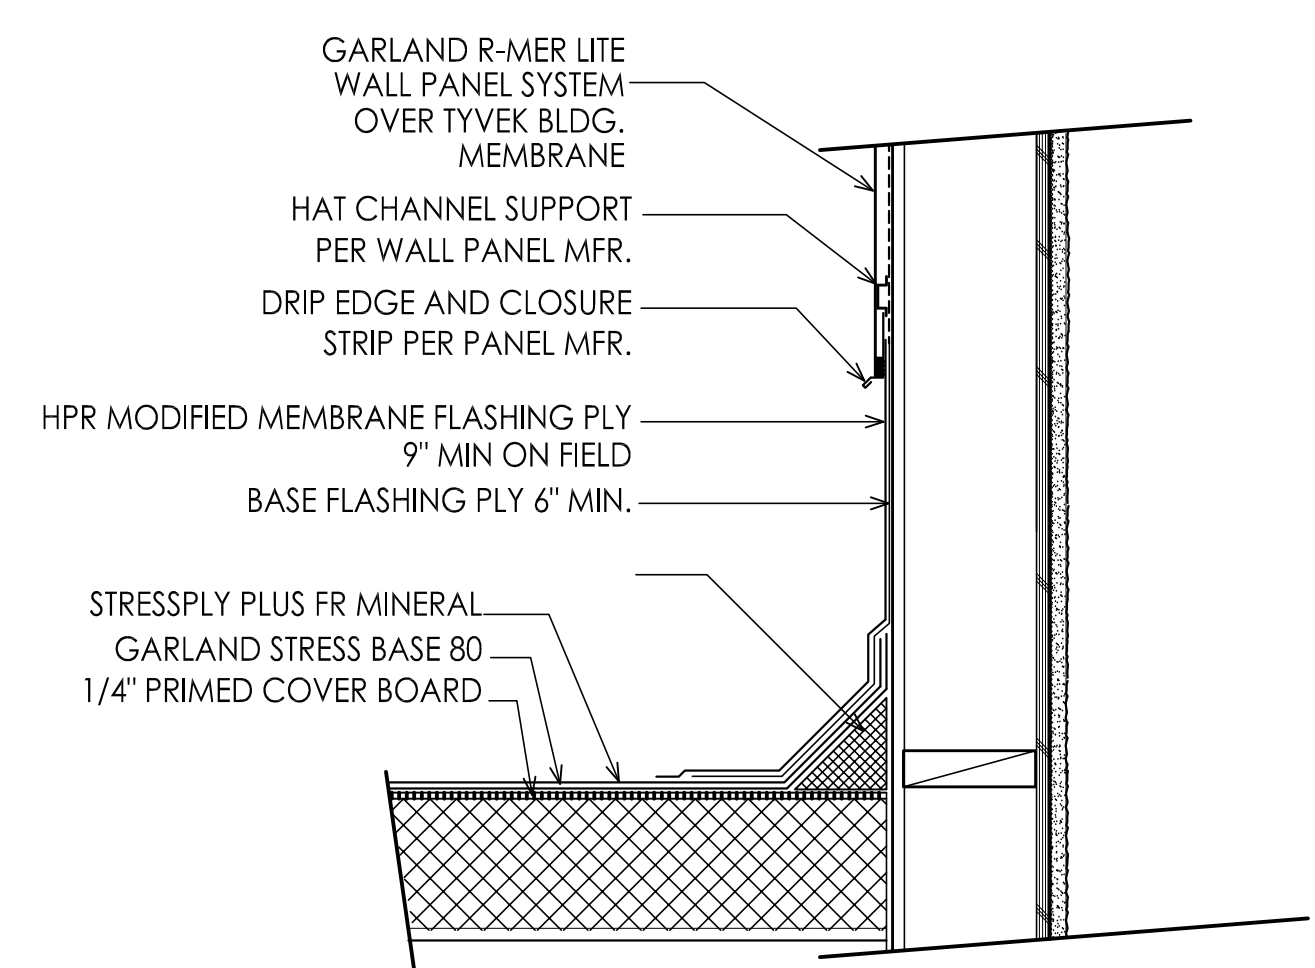


2 ROOF TO WALL TRANSITION  
 24x36 - 1 1/2" = 1'-0"  
 12x18 - 3/4" = 1'-0"

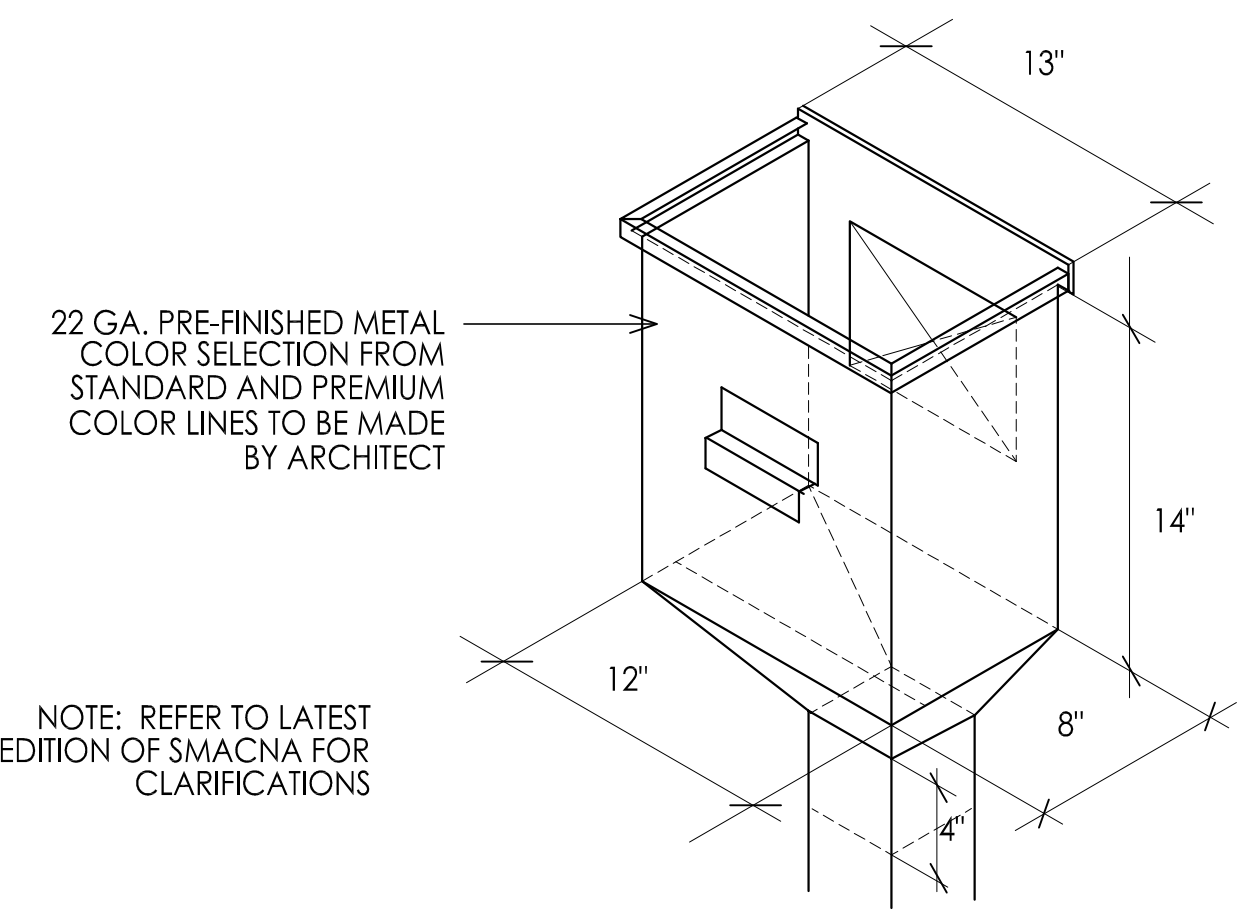

3 CONDUCTOR HEAD  
 24x36 - 1-1/2"=1'-0"  
 12x18 - 3/4" = 1'-0"

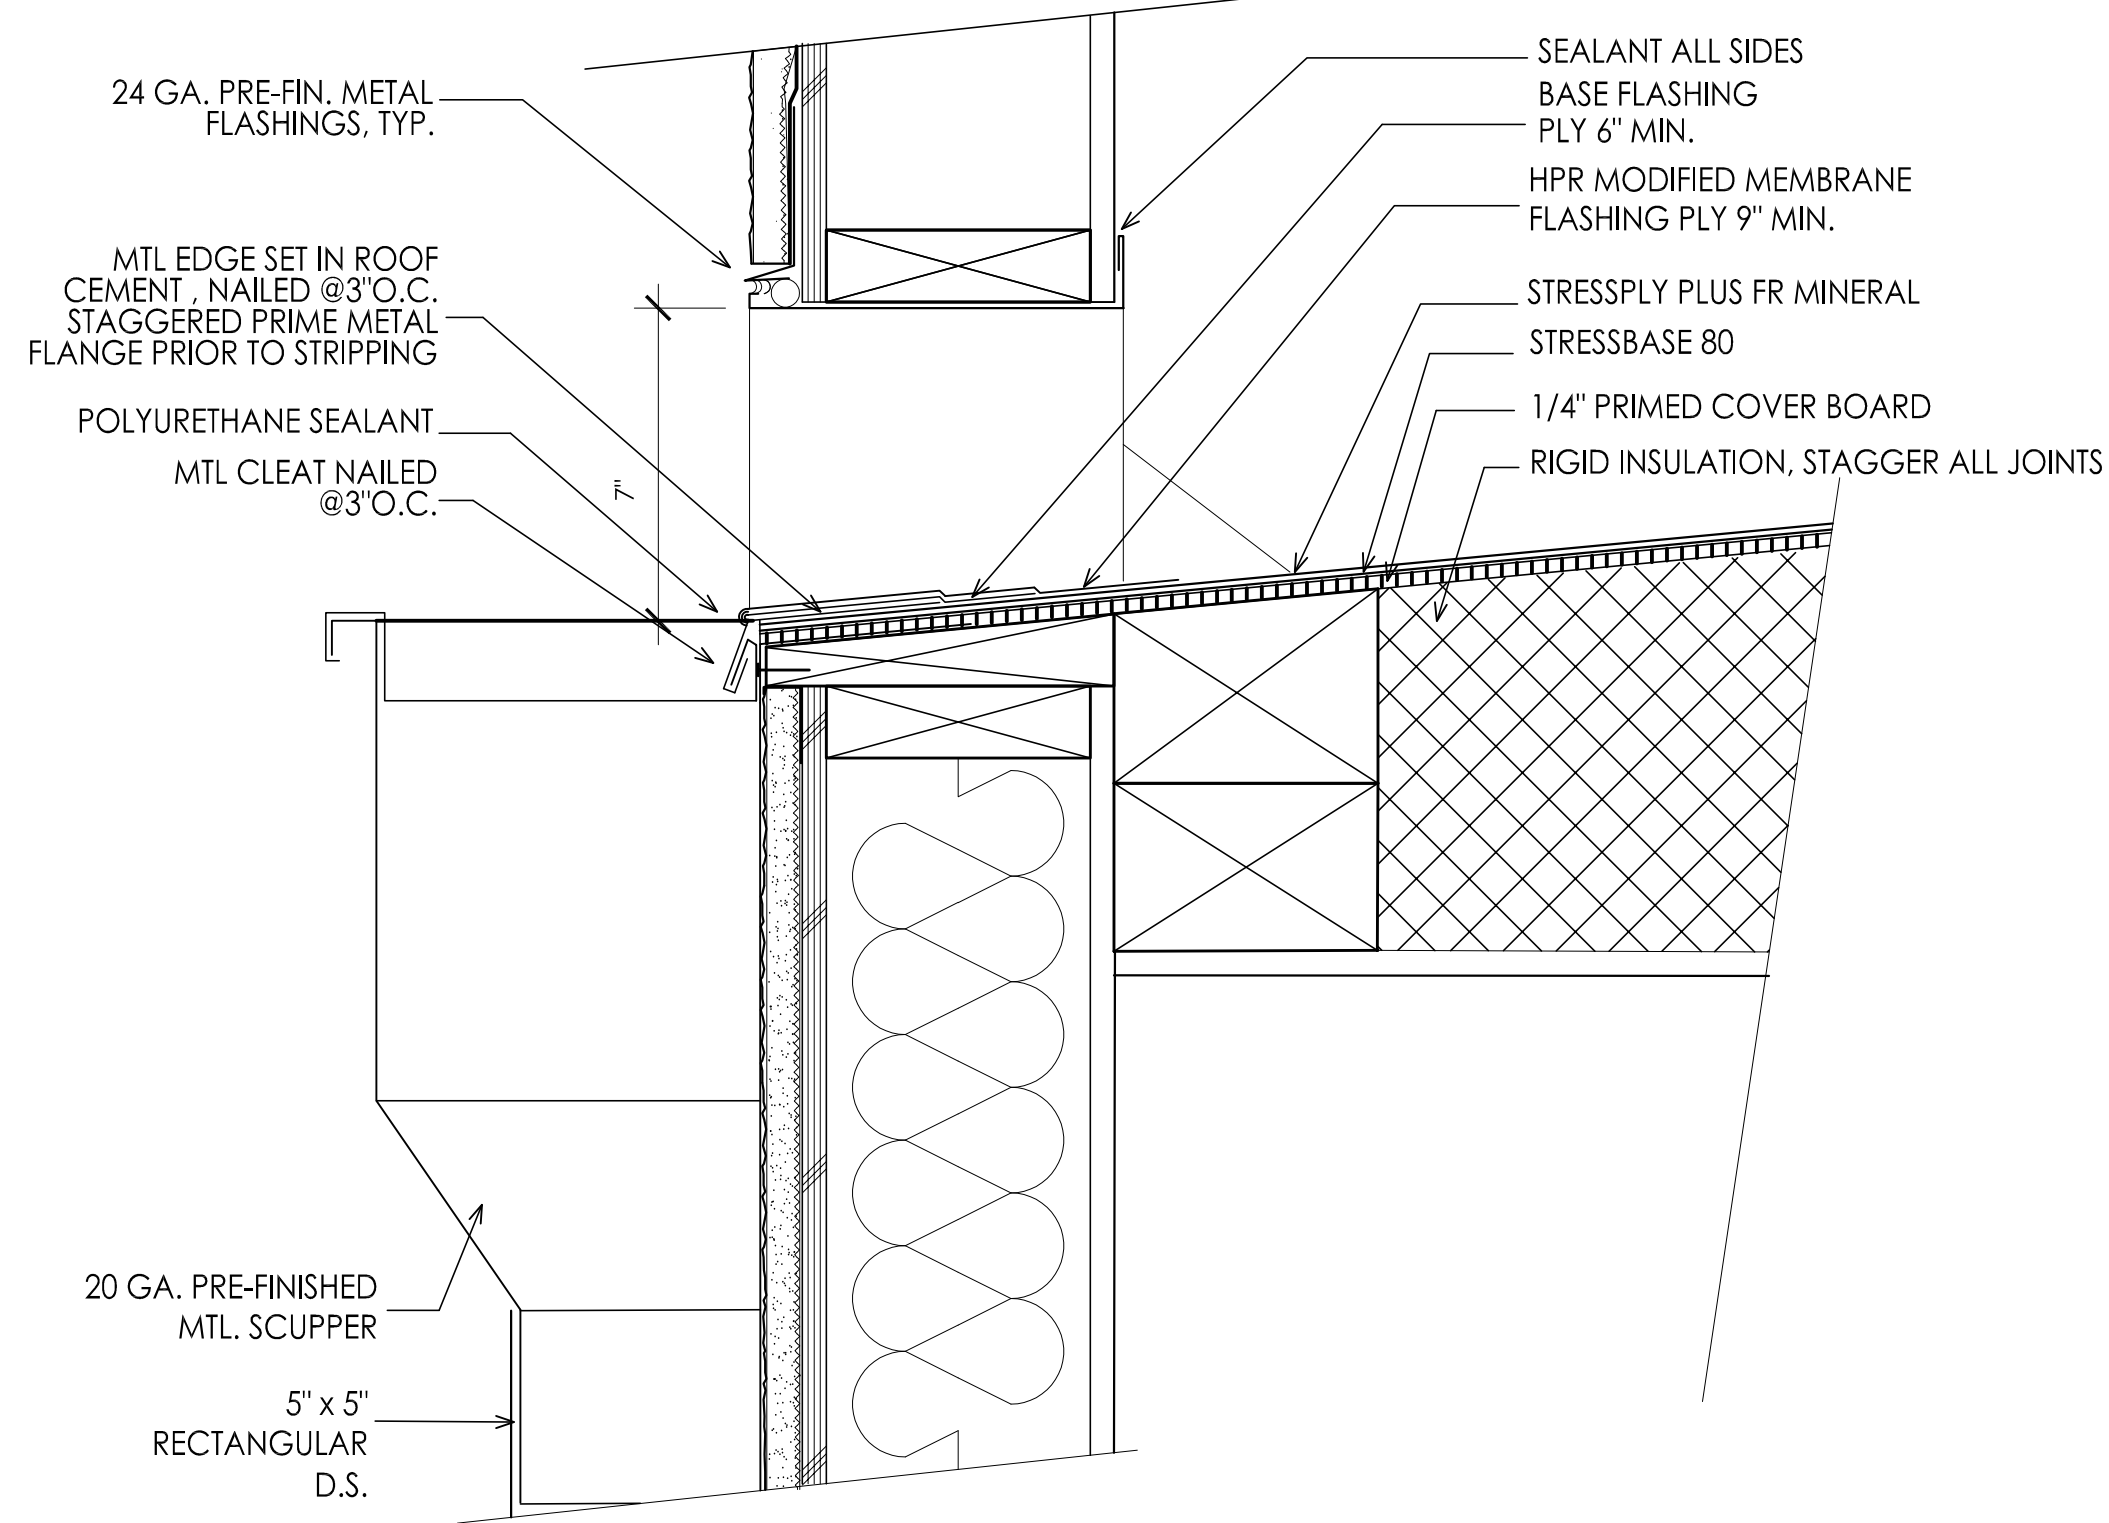

4 SCUPPER SECTION  
 24x36 - 3"=1'-0"  
 12x18 - 1 1/2" = 1'-0"  
 SIMILAR @ OVER FLOW, INLET 2" ABOVE PRIMARY

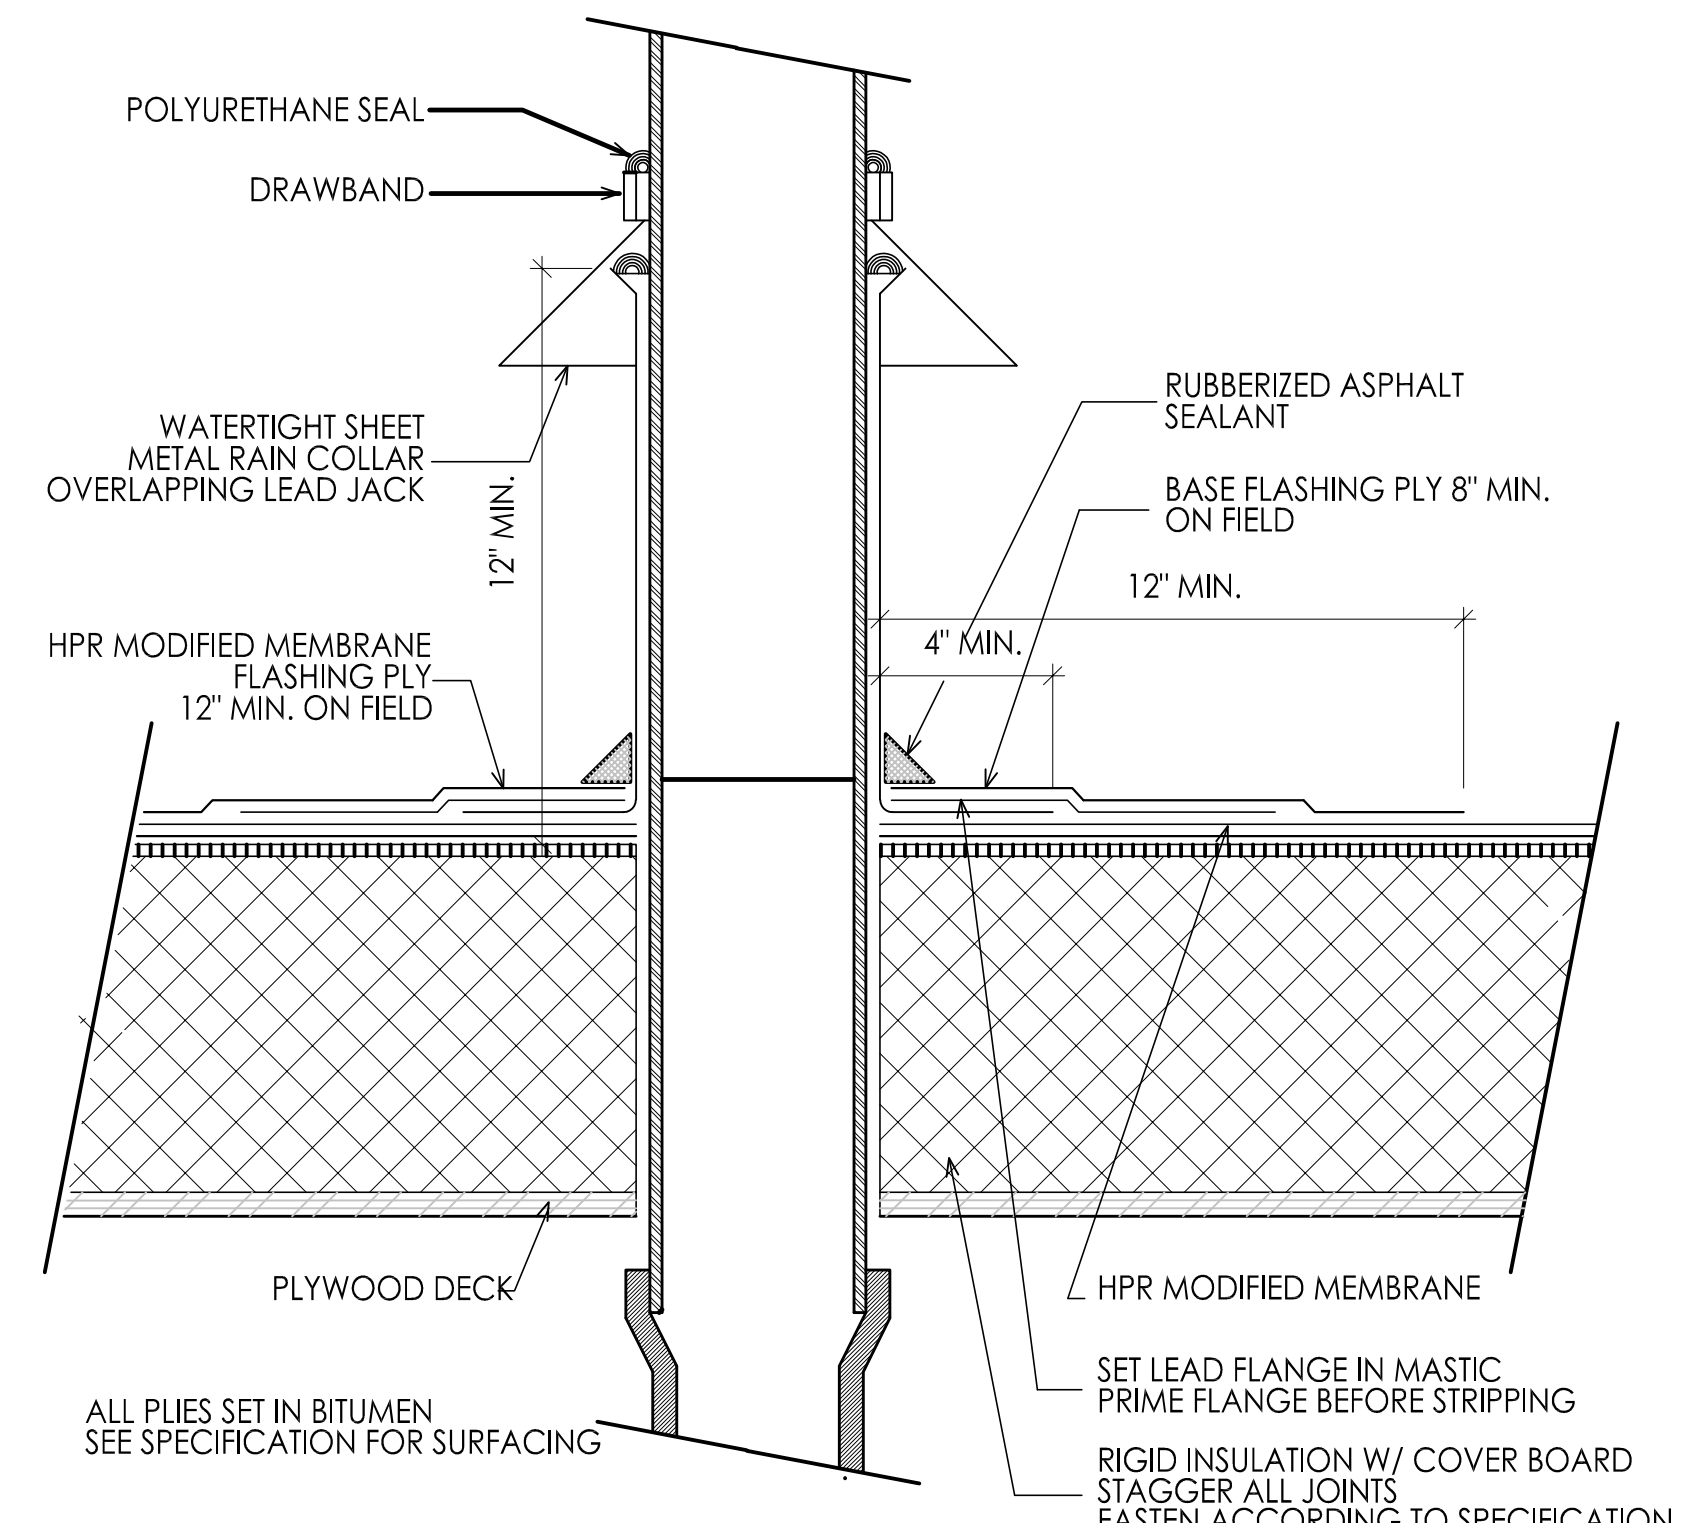

5 VENT STACK DTL. TYP.  
 24x36 - 3"=1'-0"  
 12x18 - 1 1/2" = 1'-0"

City of Puyallup  
 Development & Permitting Services  
 ISSUED PERMIT

Building	Planning
Engineering	Public Works
Fire	Traffic

AUSTINCINA architects p.s.  
 12202 Pacific Ave. Suite C  
 Tacoma, Washington 98444  
 P: 253.531.4300 F: 253.537.6542  
 E: architects@austincina.com

3872 REGISTERED ARCHITECT  
 MICHAEL CINA  
 STATE OF WASHINGTON

ROOF DETAILS

Addition to Hampton Inn & Suites  
 Hampton Inn & Suites  
 1515 S. Meridian, Puyallup, WA

Job #:  
 Date: January 6, 2020  
 Revs:

A7.3  
 PERMIT SET