

# Raceway Install


For Top sign "TANDOORI GRILL"

Reviewed 4/18/2022 DL Subject to field inspectors approvals.

City of Puyallup Development & Permitting Services	
<b>ISSUED PERMIT</b>	
Building	Planning
Engineering	Public Works
Fire	Traffic

140 lbs or less

IF WOOD USE LAGS OR ANKER BOLTS

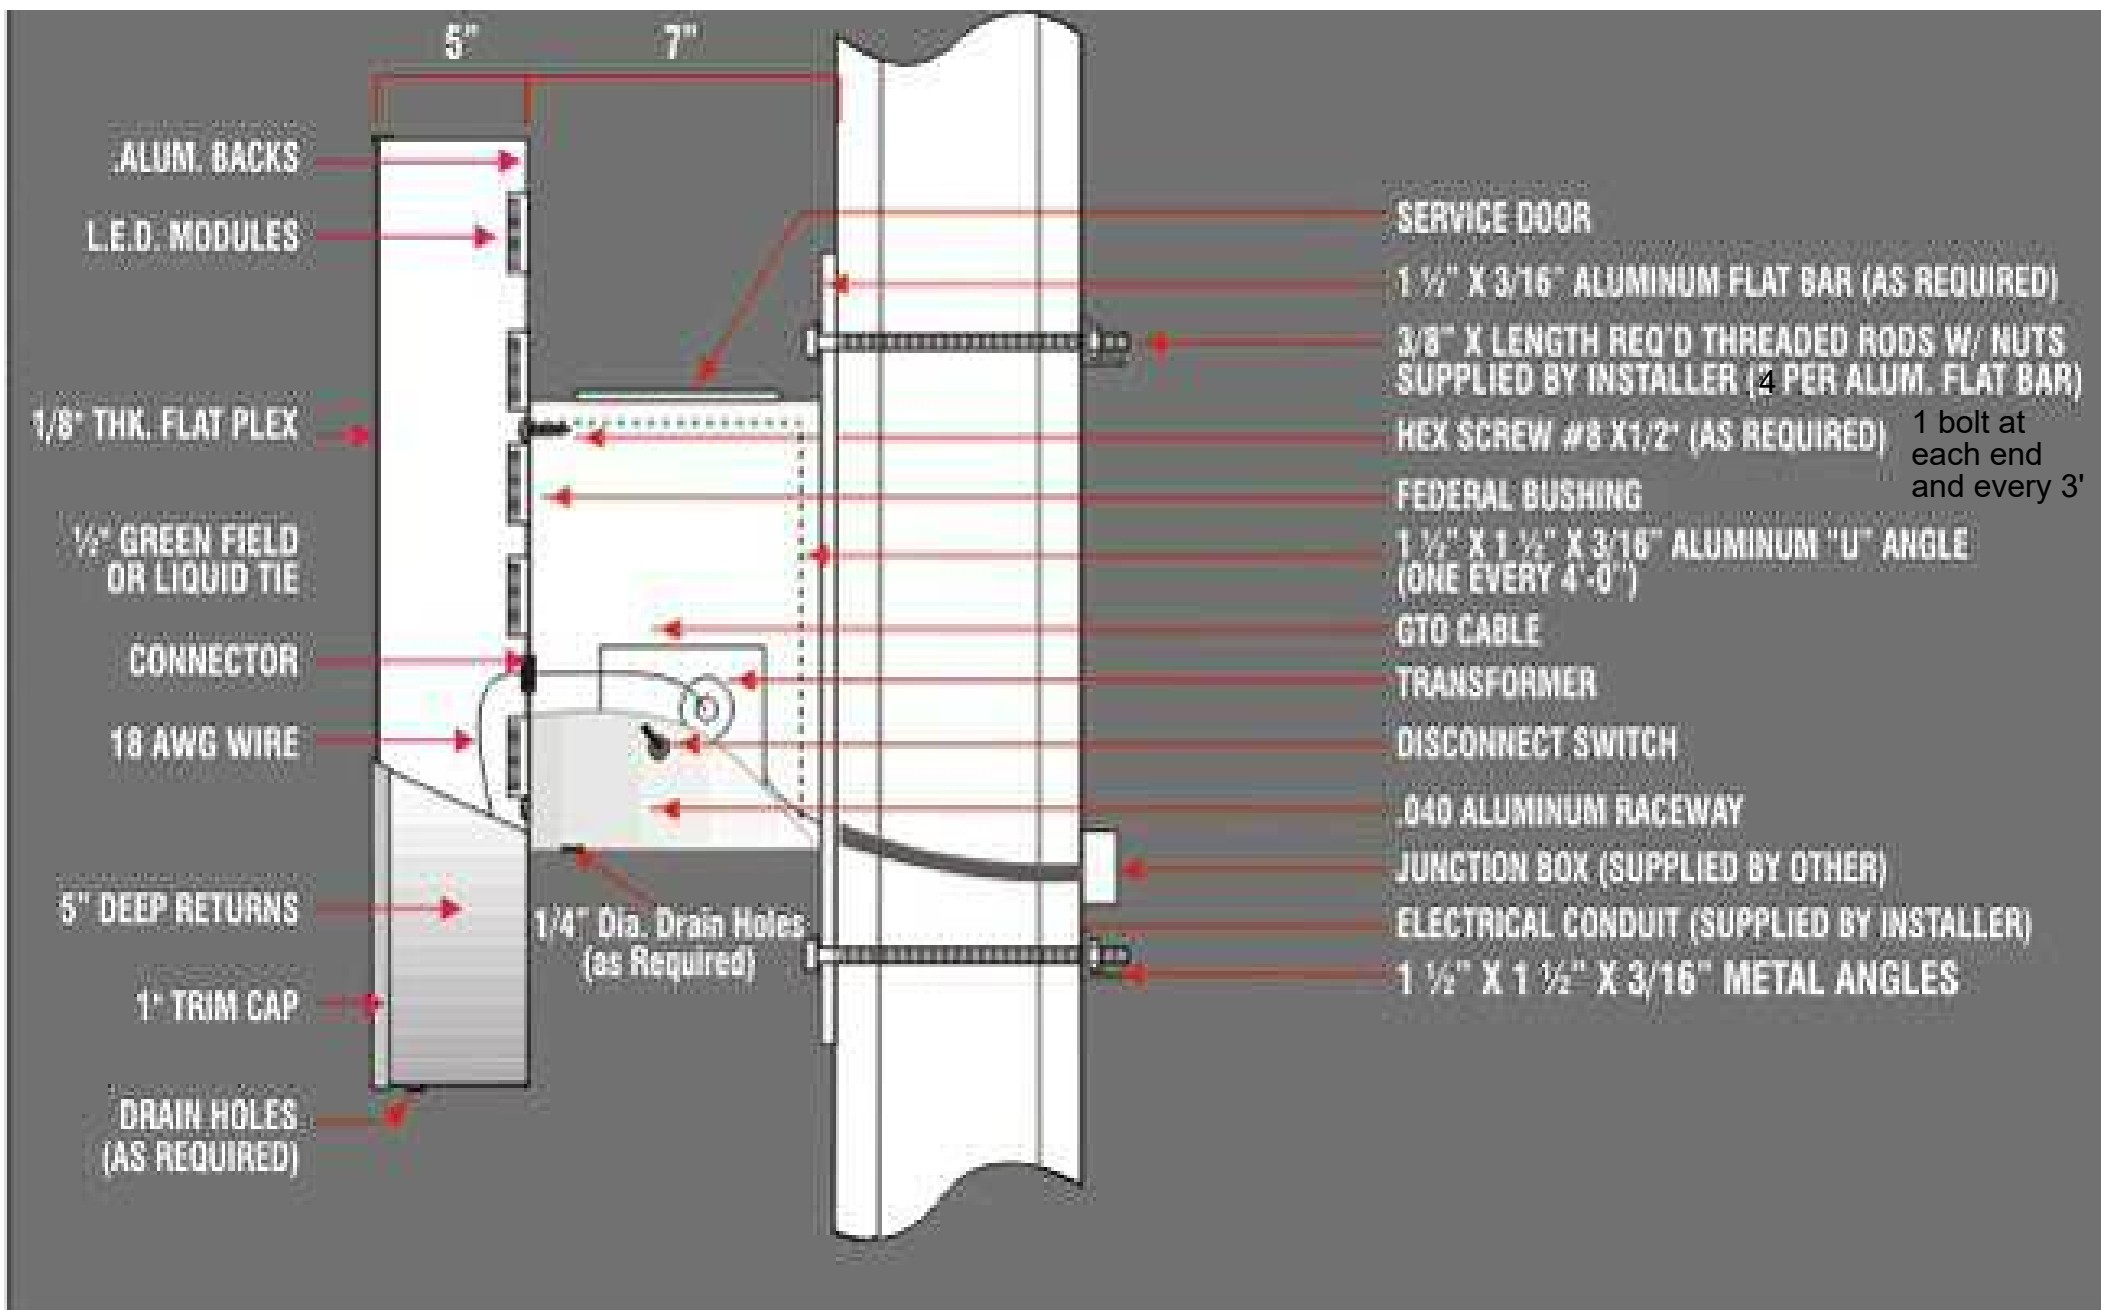


PRSG20220511

# LED FLUSH MOUNT CLOUD SIGN Install

For Bottom sign "FINE INDIAN GRILL"

Reviewed 4/18/2022 DL Subject to field inspectors approvals.

30 lbs

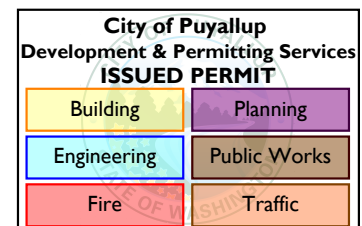

GAVANIZED STEEL  
WALL SUFACE

12 VOLT ELECTRONIC  
TRANSFORMER MOUNTED  
WITHIN WIRING BOX

SHUT OFF SWITCH  
WIRING COMPARTMENT

PRIMARY WIRING WITHIN  
STEEL CONDUIT. DEDICATED  
20 AMP CIRCUIT BY OWNER

2"X4" STEEL STUDS 16" O/C

1/2" CDX PLYWOOD

(E.F.I.S./STUCCO) FINISHED SURFACE

1" TRIMCAP

1/8" PIGMENTED PLEX FACE

3/8" X 2 1/2" LAG SCREWS  
(3' MINIMUM)

LIQUATITE" FLEXIBLE  
CONDUIT & FITTINGS

L.E.D. ILLUMINATION

.040" ALUMINUM SIDES  
AND BACKS

PRSG20220511