

**City of Puyallup
Fire
REVIEWED
FOR
COMPLIANCE**

DDrake
05/18/2022
2:44:52 PM



Approval of submitted plans is not an approval of omissions or oversight by this office or noncompliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable building codes and regulations of the local government.

THE APPROVED CONSTRUCTION PLANS AND ALL ENGINEERING MUST BE POSTED ON THE JOB AT ALL INSPECTIONS IN A VISIBLE AND READILY ACCESSIBLE LOCATION.


**City of Puyallup
Development & Permitting Services
ISSUED PERMIT**

Building	Planning
Engineering	Public Works
Fire	Traffic

TYPE 1 - Kitchen Hood

1 Hood - 12' Hood Length
32 TOTAL FLOWS / 8 NOZZLES

**CaptiveAire TANK 8 Gallon System
(40 Flow Capacity)**

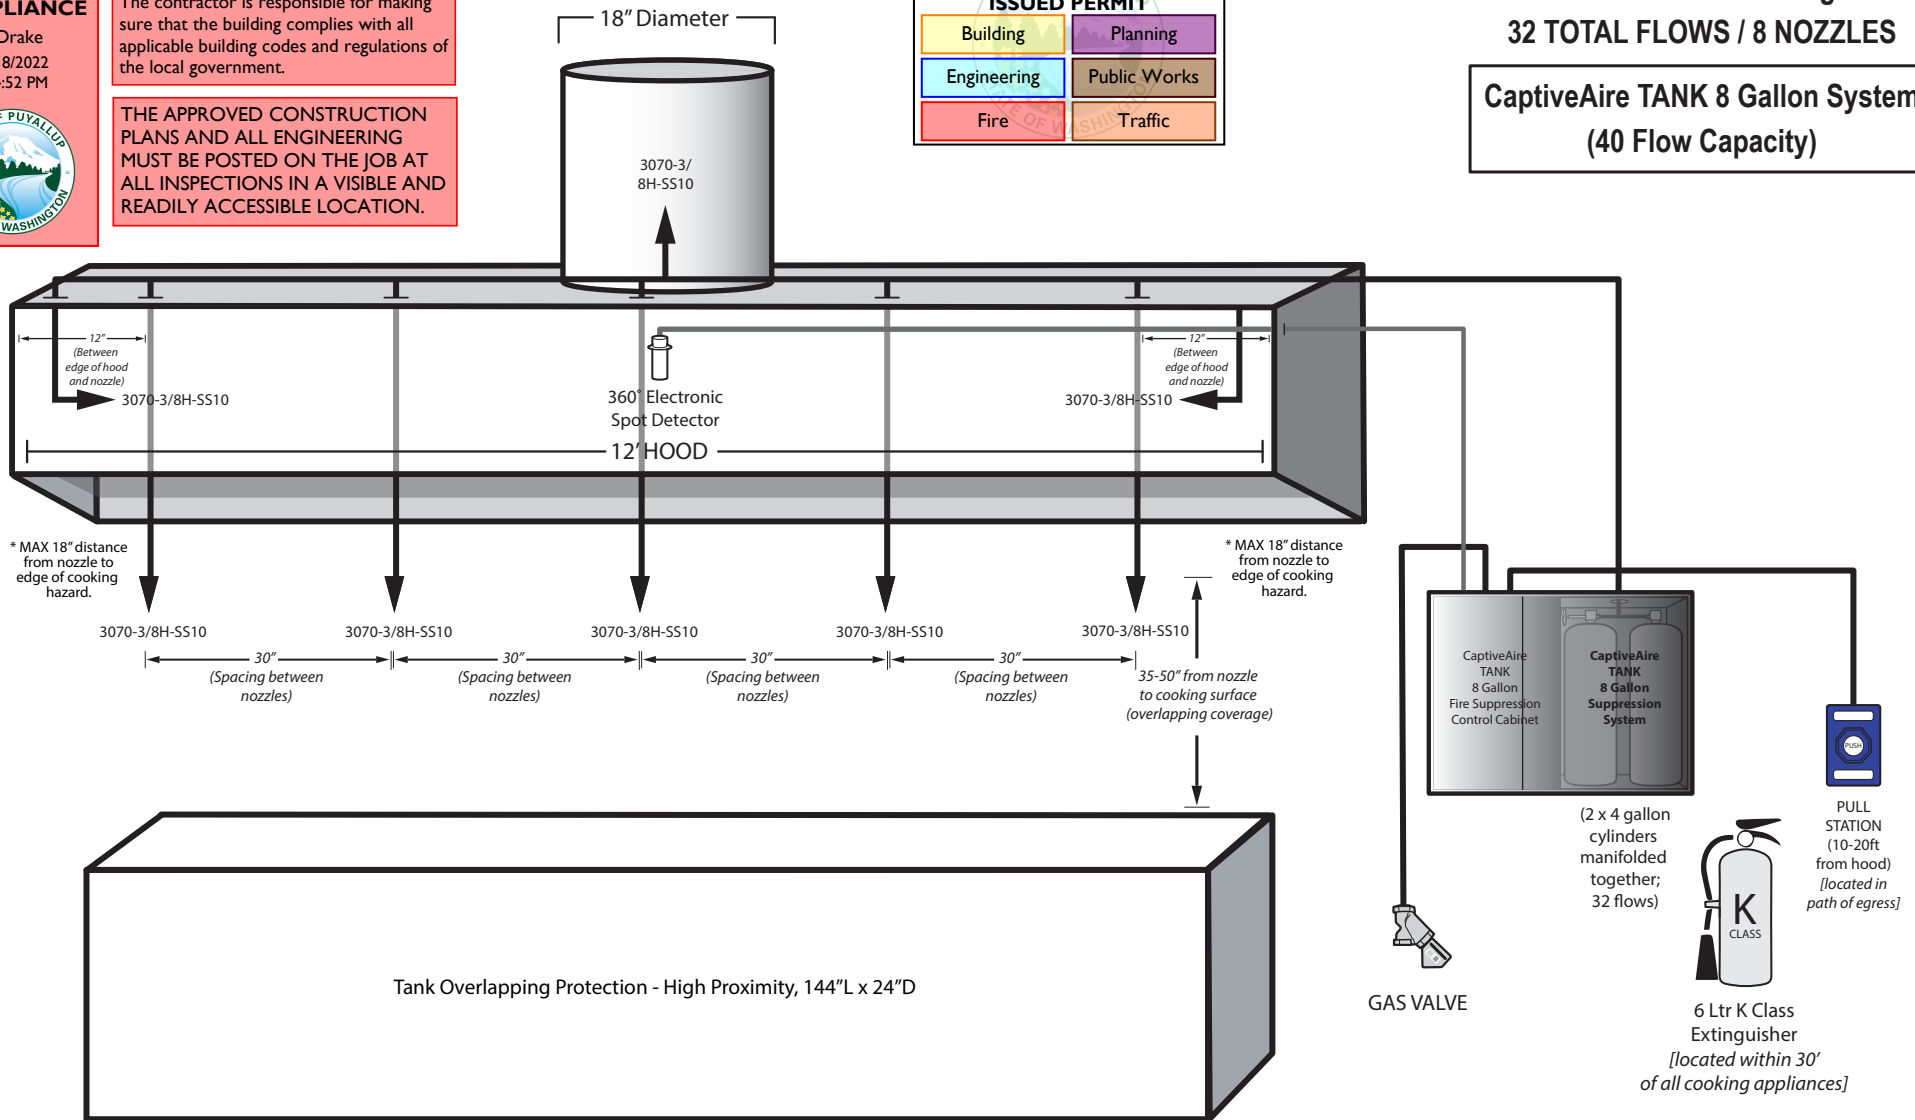

DRAWN BY: Holly Gualco
CHECKED BY: Darin Wall
PLOT DATE: 05/17/22
FS-1
SHEET NUMBER:

TANDOORI GRILL
4425 S MERIDIAN
PUYALLUP, WA 98373

SHEET TITLE: Fire Suppression System Schematic

- GENERAL NOTES:**
- 3/4" pipe used in all distribution piping.
 - Fire Suppression System to be tied into building fire alarm (if applicable).
 - 20 MAX flow points per 4 gallon cylinder.
 - Upon activation of fire suppression system, all gas or electrical power supply under the hood will shut down.

INITIALS	REVISION	DATE
HG	Issued For Construction	05/17/22

**ALEXANDER GOW
FIRE EQUIPMENT CO.**
1436 NW 53RD STREET
SEATTLE, WA 98107
PH: (206) 632-2810
FX: (206) 633-0434

