


TYPE 1 - Kitchen Hoods  
22 TOTAL FLOWS / 18 NOZZLES

Badger Range Guard System  
(24 Flow Capacity)  
Covering Four 9' Hoods

FRONT OF HOODS

City of Puyallup  
Building  
REVIEWED  
FOR  
COMPLIANCE  
RayC  
07/13/2022  
10:22:31 AM




Approval of submitted plans is not an approval of omissions or oversight by this office or noncompliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable building codes and regulations of the local government.

THE APPROVED CONSTRUCTION PLANS AND ALL ENGINEERING MUST BE POSTED ON THE JOB AT ALL INSPECTIONS IN A VISIBLE AND READILY ACCESSIBLE LOCATION.


City of Puyallup  
Development & Permitting Services  
ISSUED PERMIT

Building	Planning
Engineering	Public Works
Fire	Traffic

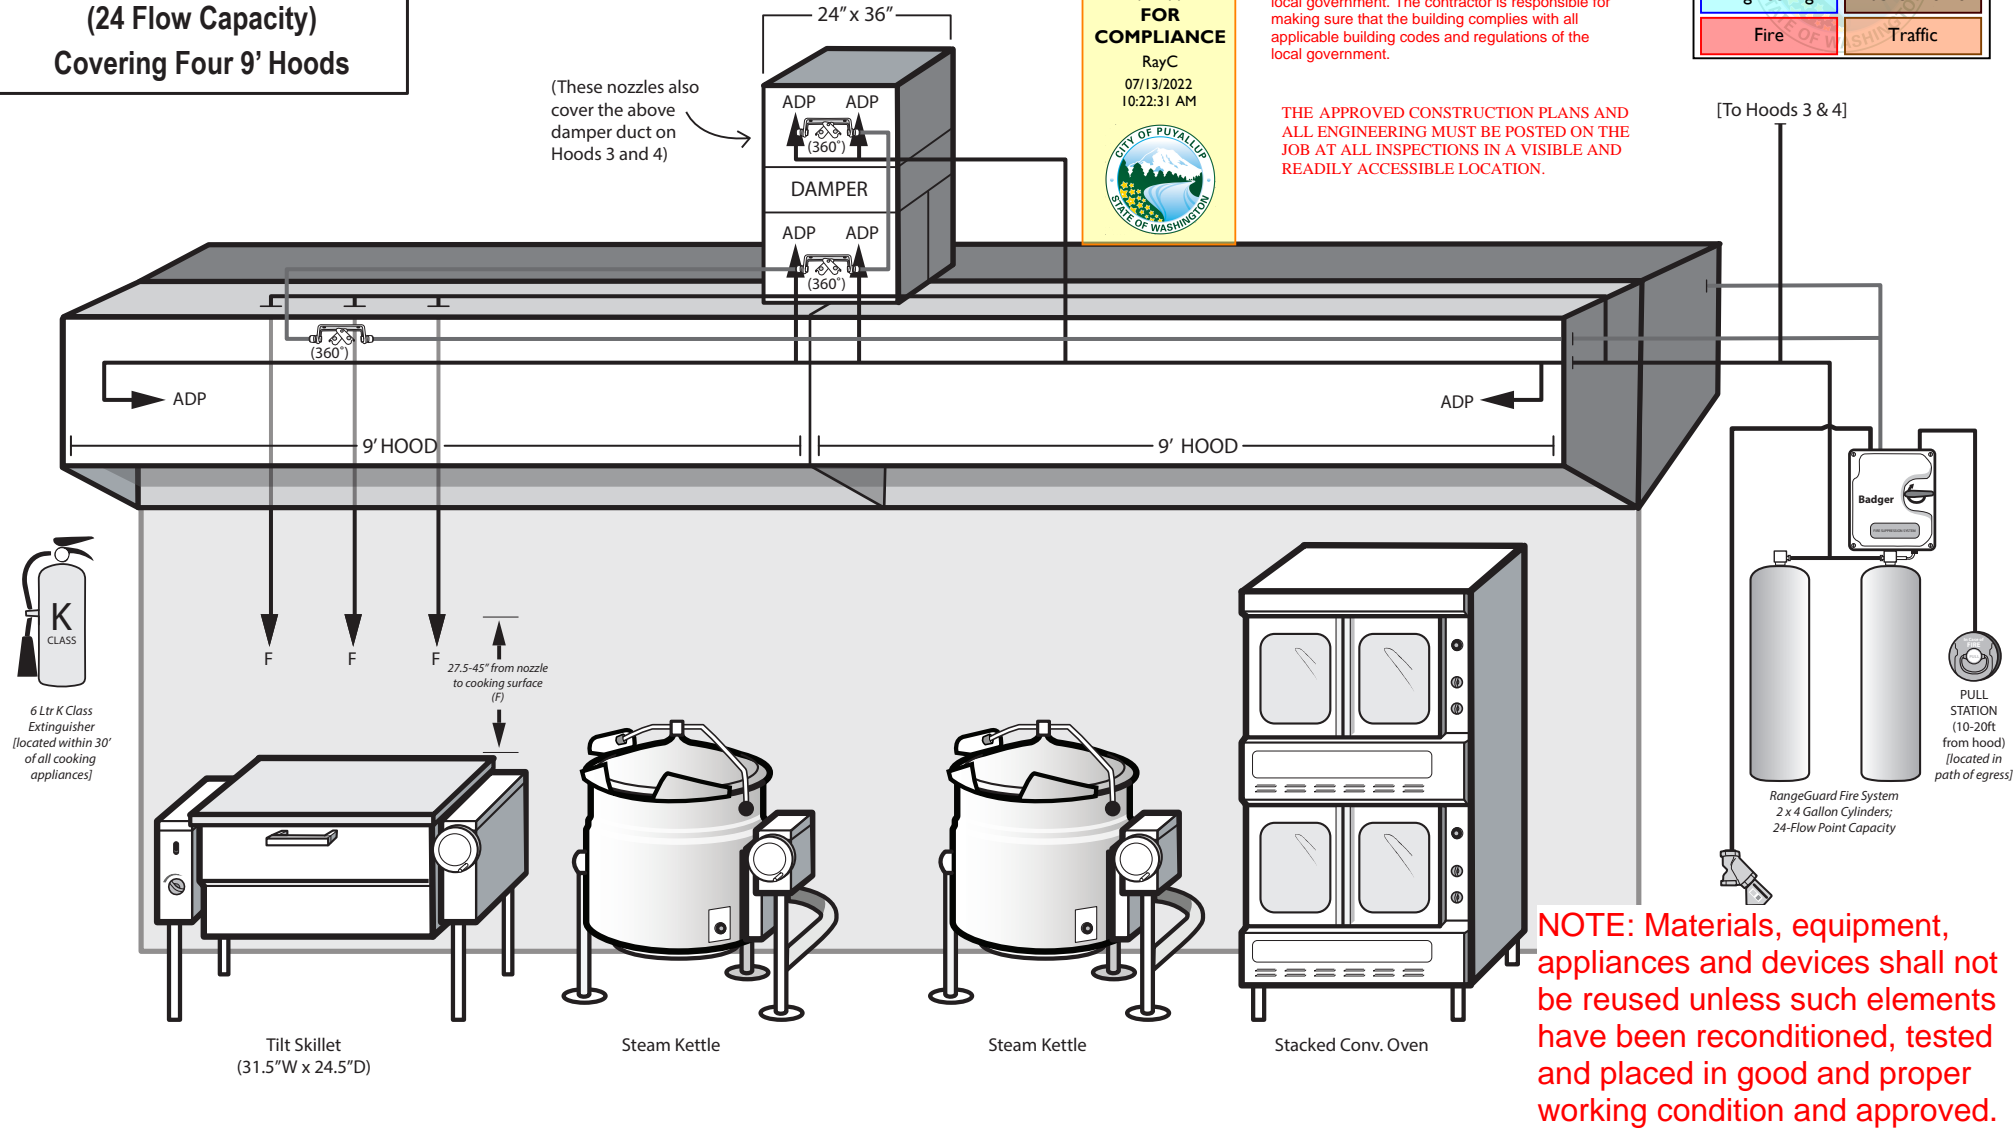

NOTE: Materials, equipment, appliances and devices shall not be reused unless such elements have been reconditioned, tested and placed in good and proper working condition and approved.

10 flow points in duct/plenum protection - duplicate flow points are denoted on the 'BACK SIDE OF HOOD' drawing with an "\*", 12 flow points used in appliance nozzle protection.

DRAWN BY: Holly Gualco	<b>FERUCCI JUNIOR HIGH SCHOOL</b> 3213 WILDWOOD PARK DRIVE PUYALLUP, WA 98374	<b>GENERAL NOTES:</b> 1. 3/4" pipe used in all distribution piping. 2. Fire Suppression System to be tied into building fire alarm (if applicable). 3. 12 MAX flow points per 4 gallon cylinder. 4. Upon activation of fire suppression system, all gas or electrical power supply under the hood will shut down.	INITIALS	REVISION	DATE	<b>ALEXANDER GOW FIRE EQUIPMENT CO.</b> 1436 NW 53RD STREET SEATTLE, WA 98107 PH: (206) 632-2810 FX: (206) 633-0434	
CHECKED BY: Joshua Gualco			HG	Issued For Construction	10/22/21		
PLOT DATE: 10/22/21							
<b>FS-1</b> SHEET NUMBER:	SHEET TITLE: Fire Suppression System Schematic						

TYPE 1 - Kitchen Hoods  
22 TOTAL FLOWS / 18 NOZZLES

Badger Range Guard System  
(24 Flow Capacity)  
Covering Four 9' Hoods

BACK OF HOODS

City of Puyallup  
Development & Permitting Services  
ISSUED PERMIT

Building


Engineering

Fire

Planning

Public Works

Traffic

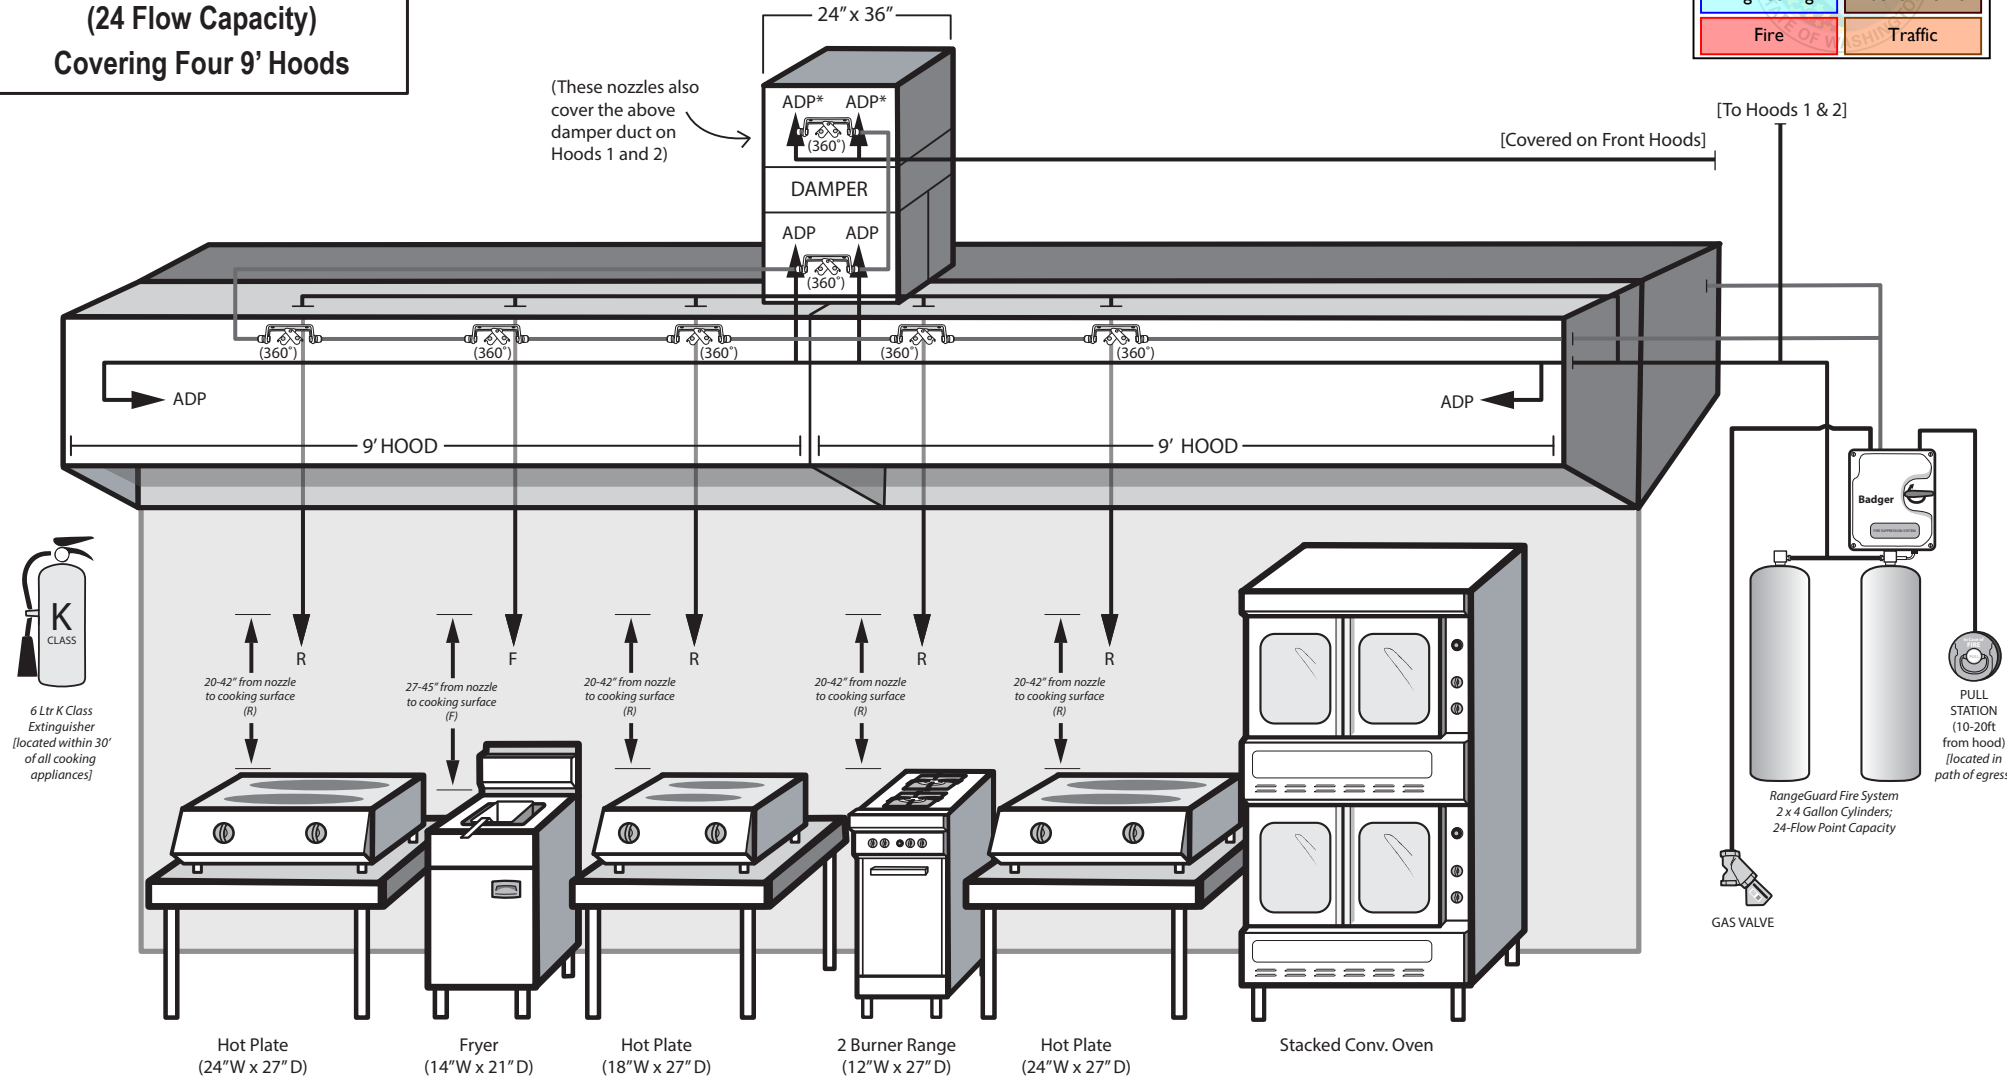

10 flow points in duct/plenum protection - duplicate flow points are denoted on the 'BACK SIDE OF HOOD' drawing with an "\*", 12 flow points used in appliance nozzle protection.

DRAWN BY: Holly Gualco

CHECKED BY: Joshua Gualco

PLOT DATE: 10/22/21

FS-2

SHEET NUMBER:

FERUCCI JUNIOR HIGH SCHOOL

3213 WILDWOOD PARK DRIVE

PUYALLUP, WA 98374

SHEET TITLE: Fire Suppression System Schematic

GENERAL NOTES:

1. 3/4" pipe used in all distribution piping.

2. Fire Suppression System to be tied into building fire alarm (if applicable).

3. 12 MAX flow points per 4 gallon cylinder.

4. Upon activation of fire suppression system, all gas or electrical power supply under the hood will shut down.

INITIALS

REVISION

DATE

HG

Issued For Construction

10/22/21

ALEXANDER GOW

FIRE EQUIPMENT CO.

1436 NW 53RD STREET

SEATTLE, WA 98107

PH: (206) 632-2810

FX: (206) 633-0434