


COSTCO PUYALLUP LOCKER ROOM REMODEL FIRE ALARM PLAN

FIRE ALARM SYSTEM LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR (MOUNT ON A 2-1/8" 4-SQUARE WITH 3" Ø MUD RING.)
Ⓢ _A	SMOKE DETECTOR - LOCATED ABOVE ACT TILE (MOUNT ON A 2-1/8" 4-SQUARE WITH 3" Ø MUD RING.)
*	STROBE - CEILING (MOUNT ON A 4-SQUARE BOX WITH A SINGLE GANG MUD RING)
Ⓢ	HORN/STROBE - CEILING (MOUNT ON A 4-SQUARE BOX WITH A SINGLE GANG MUD RING)



FIRE ALARM WIRING LEGEND	
A	2 COND 16 AWG WEST PENN 60991B OR EQUAL
B	2 COND 14 AWG WEST PENN 60993B OR EQUAL

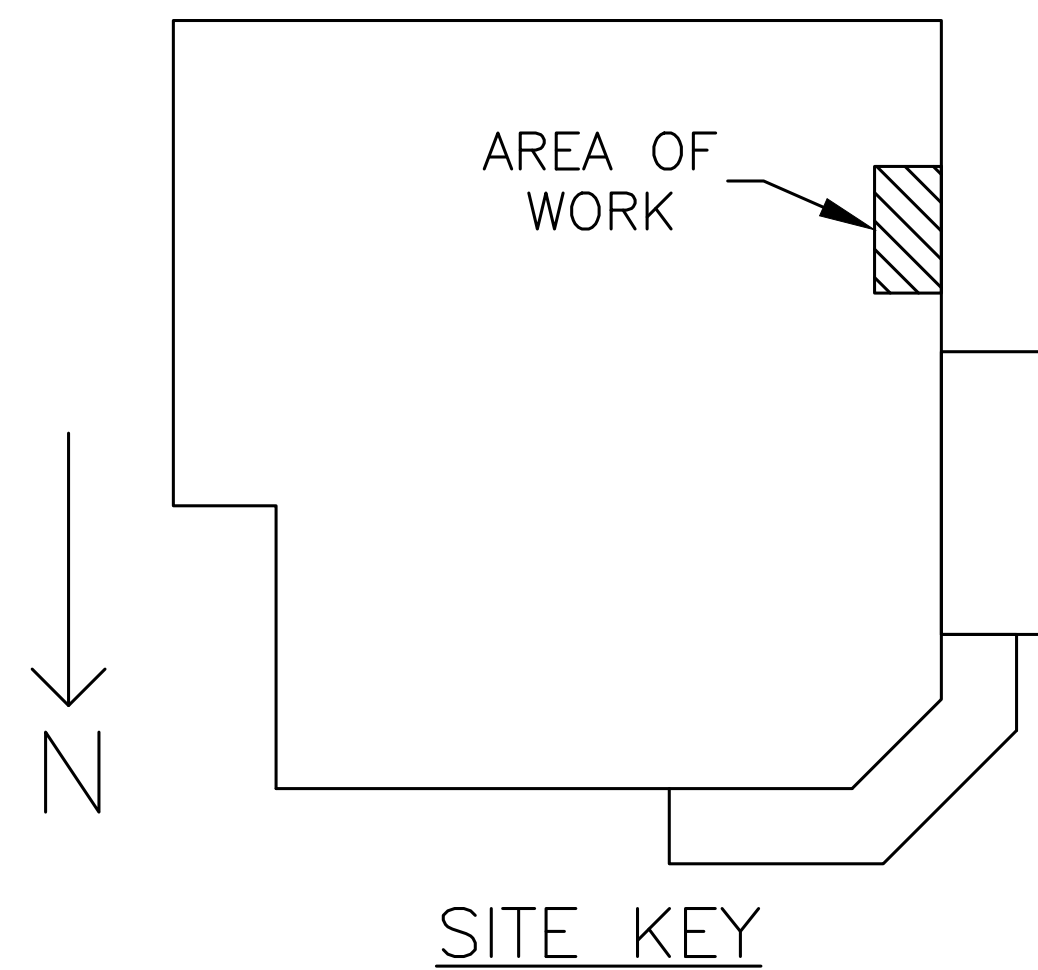

DRAWINGS REVIEWED BY:
 JEFFREY L BLOOMQUIST
 NICET FIRE PROTECTION
 ENGINEERING TECHNOLOGY
 FIRE ALARM SYSTEMS, LEVEL III
 TECHNICIAN ID: 91254
 CERTIFICATION EXPIRES: APRIL 1, 2023



1ST FLOOR
FIRE ALARM PLAN

SCALE: 1/8" = 1'-0"

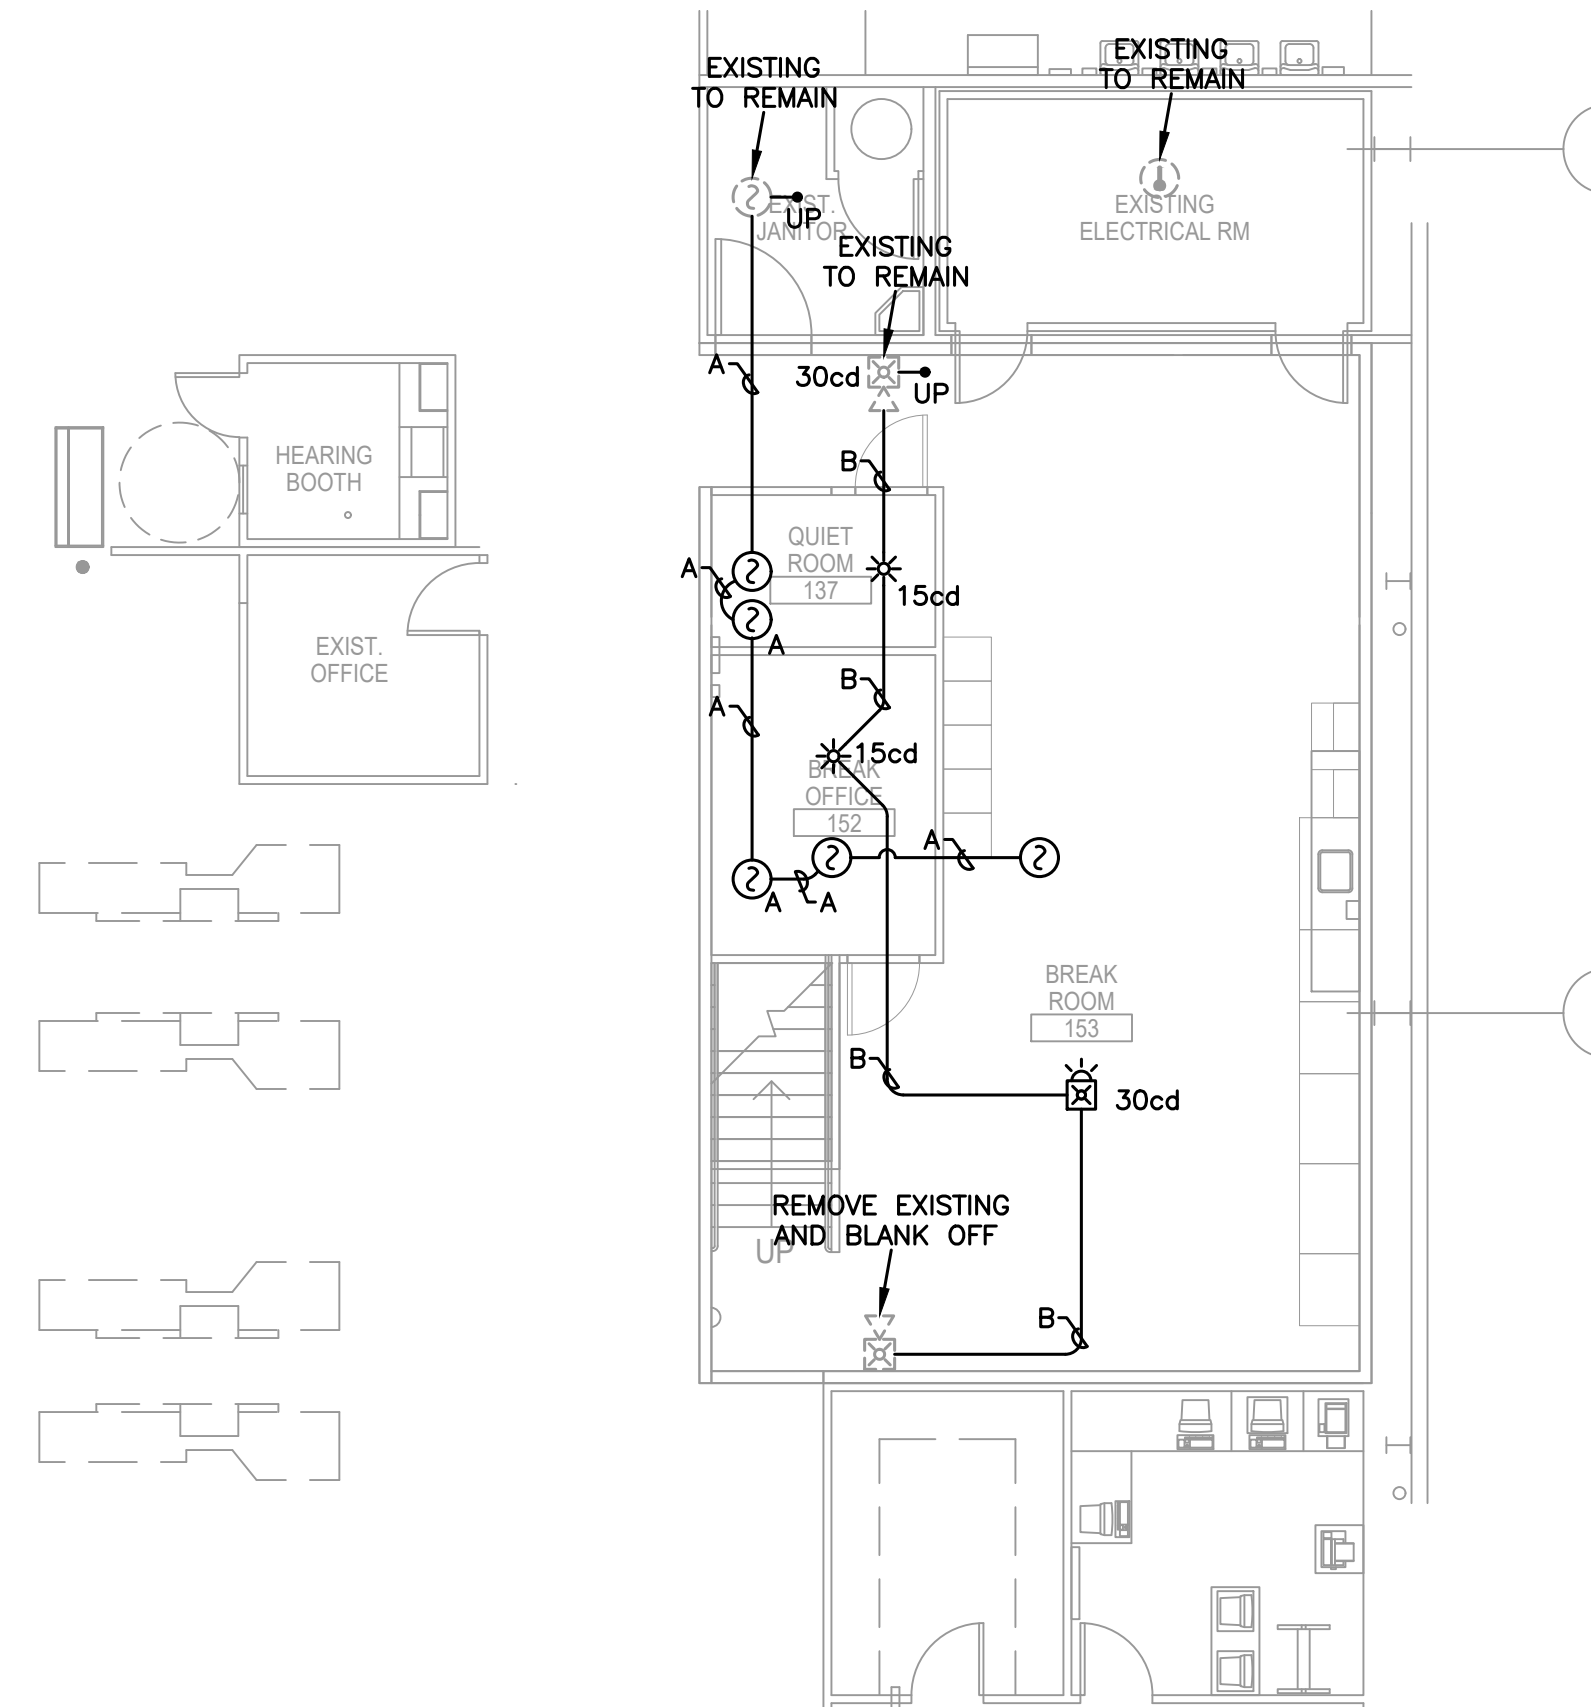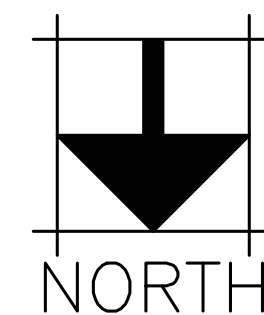

MEZZANINE
FIRE ALARM PLAN

SCALE: 1/8" = 1'-0"

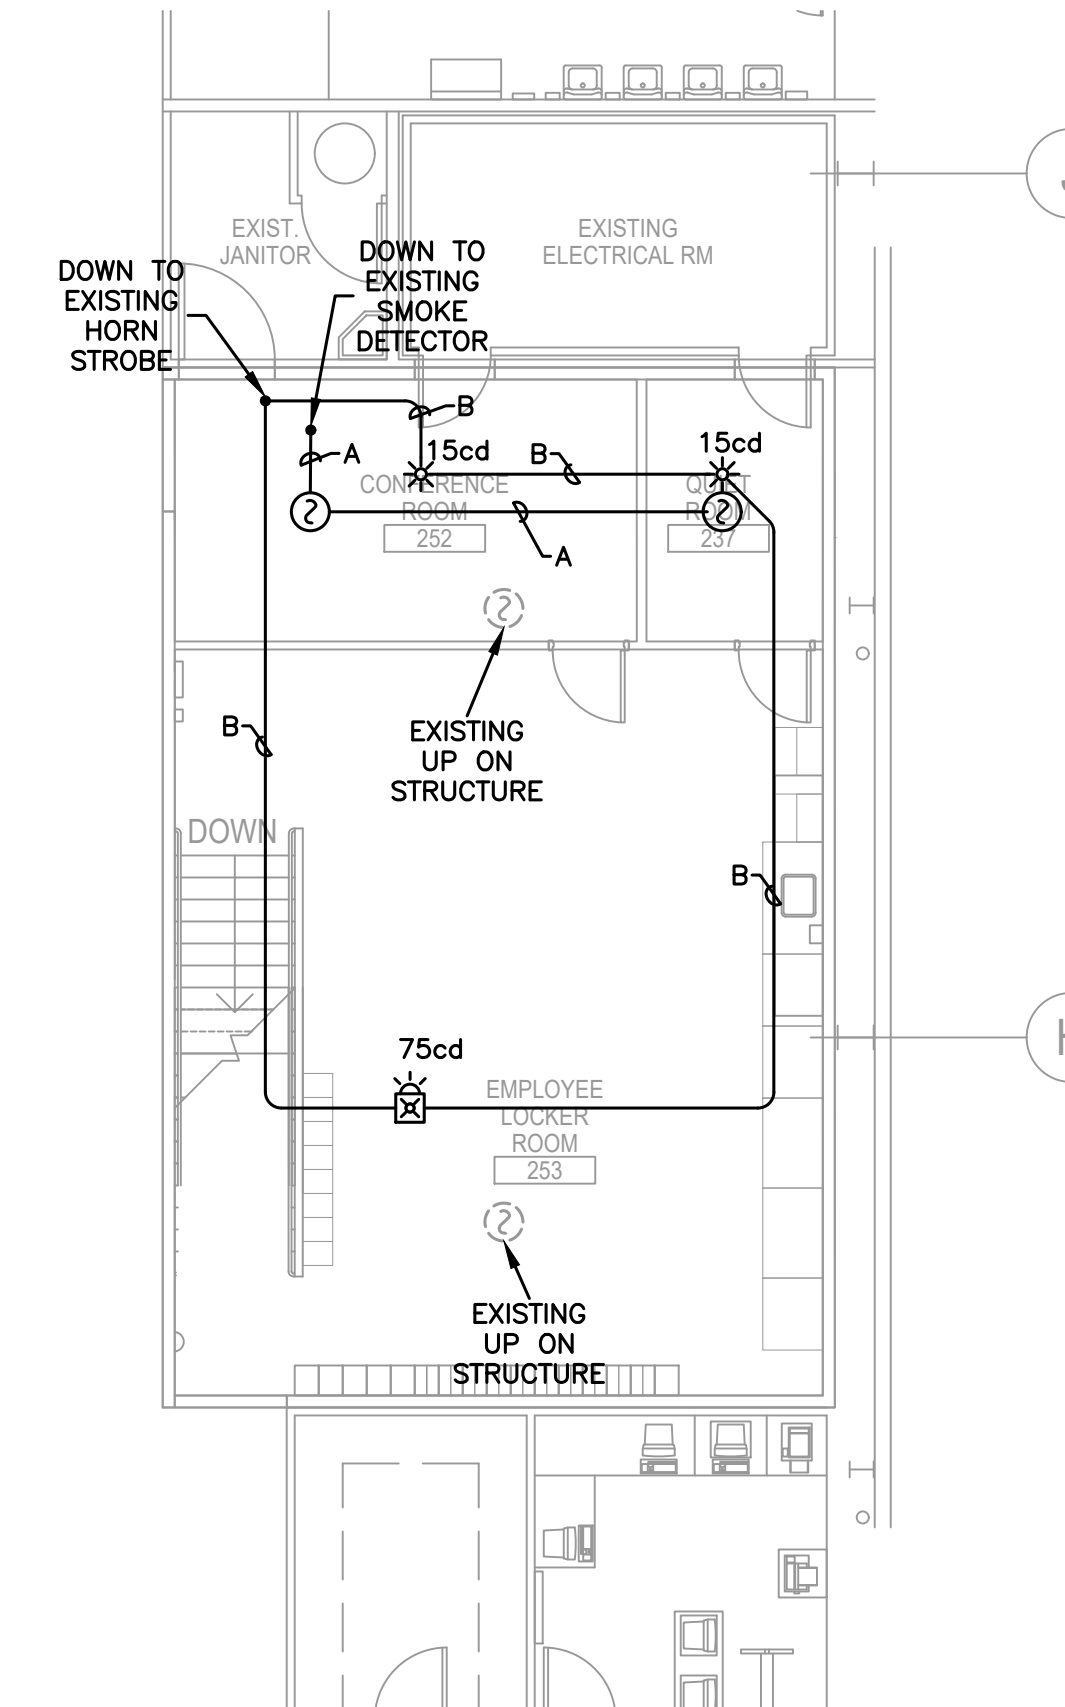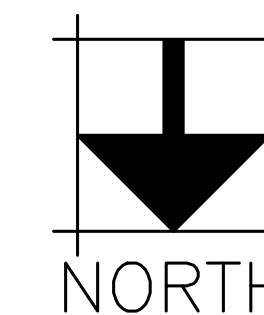

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building	Planning
Engineering	Public Works
Fire	Traffic

City of Puyallup
Fire
REVIEWED FOR COMPLIANCE

DDrake
09/27/2022
7:46:03 AM

APPROVALS

THE APPROVED CONSTRUCTION PLANS AND ALL ENGINEERING MUST BE POSTED ON THE JOB AT ALL INSPECTIONS IN A VISIBLE AND READILY ACCESSIBLE LOCATION.

Approval of submitted plans is not an approval of omissions or oversight by this office or noncompliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable building codes and regulations of the local government.

**SOUND
ELECTRONICS**
3409 SOUTH 37th STREET
Tacoma, Washington 98409
(253) 472-2965 1-800-656-3550

ELECTRICAL CONTRACTOR
CUTTER ELECTRIC
PO BOX 5789
KENT, WA 98064

NO.	REVISION	DATE
A	SUBMITTAL	8/31/22

PROJECT NUMBER	2268-020
BUILDING	PUYALLUP COSTCO
	1201 39TH AVE SW
	PUYALLUP, WA 98373