

### Approval of submitted plans is not an approval of omissions or oversight by this office or noncompliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable building codes and regulations of the local government.

SITE PLAN /NOT TO SCALE

## **OCCUPANCY CALCULATIONS**

FULFILLMENT AREA - OCCUPANCY CALCULATIONS FULFILLMENT AREA: 22,350 SF FUNCTION OF SPACE: MERCANTILE OCC LOAD FACTOR: 60 GROSS OCCUPANT LOAD: 373 OCCUPANTS

MEANS OF EGRESS REQUIRED: 2

MEANS OF EGRESS PROVIDED:

FUNCTION OF SPACE: MERCANTILE OCC LOAD FACTOR: 60 GROSS OCCUPANT LOAD: 257 OCCUPANTS MEANS OF EGRESS REQUIRED: MEANS OF EGRESS PROVIDED: \*AREA OPEN TO THE PUBLIC

MERCANTILE AREA\*: 15,400 SF

2ND FLOOR RETAIL - OCCUPANCY CALCULATIONS

p — — — — — — — — <u>#/4</u>/ ∕┗┉┉┷╺┙╸╸╸╸╸┛╟ [· · · ] · · · VAALL TVELA VAALL TVELA V MALL V MALL V MALL V MALL V \_ \_ \_ \_ \_ \_ \_ \_ \_ \_ \_ \_ \_ 185 **200** ROOF ROOF **L - - - -**135 **``````** + = ++ = ++ = ++ = 8 8 8 8 8 ROOF ACCESS 8 8 8 8 8 8 + = ++ = ++ = + NOT AN EXIT + = 4+ = 4+ = 4+ = : SHIPPING TABLES (4 
 VANU
 <th EGRESS STAIR DOWN

### **EGRESS KEYNOTES**

E1. DOOR PROVIDES EXIT ACCESS TO EXISTING EXIT STAIR. A SECOND MEANS OF EGRESS IS REQUIRED FROM THIS PORTION OF THE SALES FLOOR DUE TO COMMON PATH OF EGRESS TRAVEL LIMITATIONS. THIS MEANS OF EGRESS IS PERMITTED TO PASS THROUGH AN INTERVENING SPACE IN ACCORANCE WITH 1016.2.5, EXCEPTION 2: THIS EXIT REPRESENTS < 50% OF REQUIRED EXIT ACCESS FROM THE SALES FLOOR: THE FULFILLMENT SPACE IS THE SAME HAZARD CLASSIFICATION AS THE SALES FLOOR; AND THE DOOR CANNOT BE LOCKED IN THE DIRECTION OF EGRESS. THE EGRESS ROUTE THROUGH THE FULFILLMENT AREA WILL BE DEFINED BY STRIPING ON THE FLOOR TO MAINTAIN A CLEAR PATH. E2. DOOR PROVIDES SECOND MEANS OF EGRESS FROM THIS PORTION OF THE FULFILLMENT AREA. E3. EXISTING EXTERIOR EXIT PROVIDES DIRECT EXIT FROM THE SALES FLOOR.

SECOND FLOOR EGRESS 1/32" = 1'-0"



CODE ENFORCEMENT AUTHORITIES: CITY OF PUYALLUP - DEVELOPMENT & PERMITTING SERVICES

CODES IN EFFECT: 2018 WASHINGTON STATE BUILDING CODE, CHPATER 51-50 WAC, 2018 IBC AS AMENDED. 2018 WASHINGTON STATE EXISTING BUILDING CODE. 2018 IEBC AS AMENDED. 2018 WASHINGTON STATE FIRE CODE, CHAPTER 51-4QA WAC, 2018 IFC AS AMENDED. 2018 WASHINGTON STATE MECHANICAL CODE, CHAPTER 51-52 WAC, 2018 IMC AS AMENDED. NATIONAL ELECTRICAL. CODE 2020 OF WASHINGTON, INCLUDING NFPA 70. PUYALLUP MUNICIPAL CODE - INCLUDING TITLE 16 FIRE AND TITLE 17 BUILDINGS AND CONSTRUCTION. NFPA 13-2016.

### **PROJECT DESCRIPTION:** SCOPE OF WORK CONSISTS OF INTERIOR ALTERATIONS LIMITED TO DEMOLITION OF NON

STRUCTURAL ELEMENTS, CONSTRUCTION OF NON-LOADBEARING PARTITIONS, MODIFICATIONS TO AFFECTED CEILINGS, AND INSTALLATION OF SHELVING AND MILLWORK. FULFILLMENT AREA INCLUDES OWNER-FURNISHED SHELVING UNITS FOR MERCHANDISE AND SPACE FOR ORDER PROCESSING. NO CHANGE OF USE IS PROPOSED.

NO CHANGES TO THE EXISTING BUILDING ENVELOPE PROPOSED.

AREA OF WORK: 23,640 SF. USE AND OCCUPANCY:

EXISTING GROUP M, MERCANTILE DEPARTMENT STORE NO CHANGE TO OCCUPANCY TYPE.

**TYPES OF CONSTRUCTION:** TYPE IB (ORIGINAL CONSTRUCTION UBC TYPE II-FR) **GENERAL BUILDING HEIGHTS AND AREAS:** 

AREA: NO CHANGE TO BUILDING AREA HEIGHT: NO CHANGE TO BUILDING HEIGHT

MEANS OF EGRESS EXISTING EXIT LOCATIONS TO REMAIN, NO CHANGES.

OCCUPANT LOAD NO CHANGES TO EXISTING USE OR OCCUPANCY LOADS.

SPRINKLERS EXISTING BUILDING IS FULLY SPRINKLERED.

### WORK EXEMPT FROM PERMIT

THIS PROJECT INCLUDES WORK THAT IS EXEMPT FROM PERMIT REQUIREMENTS OF THE CODE. IN ACCORDANCE WITH BUILDING CODE SECTION 105.2, INCLUDING (BUT NOT LIMITED TO): • PAINTING, TILING, CARPETING, COUNTERTOPS, AND SIMILAR FINISH WORK. NONFIXED AND MOVABLE SHELVES NOT OVER 5 FEET 9 INCHES IN HEIGHT.

### SEISMIC DESIGN DATA

A. RISK CATEGORY: II SEISMIC IMPORTANCE FACTOR: IP = 1.0

- B. MAPPED SPECTRAL RESPONSE ACCELERATIONS: SS = 1.264 S1 = 0.436
- C. SITE CLASSIFICATION: D
- D. DESIGN SPECTRAL RESPONSE COEFFICIENTS: SDS = 1.011 SD1 = 0.813
- E. SEISMIC DESIGN CATEGORY: [

### **GENERAL NOTES**


- A. COMPLY WITH CODES AND STANDARDS IN EFFECT AND AUTHORITIES HAVING JURISDICTION; WHERE REQUIREMENTS CONFLICT, COMPLY WITH THE MOST STRINGENT PROVISIONS.
- B. PROVIDE AND MAINTAIN REQUIRED EGRESS FROM BUILDING AND ALL AREAS WITHIN STRUCTURE AT ALL TIMES DURING DEMOLITION AND CONSTRUCTION. PROVIDE AND MAINTAIN BARRIERS AND OTHER PROTECTIONS TO ENSURE SAFE PASSAGE IN AND AROUND THE FACILITY.
- C. CONTRACTOR REMAINS SOLELY RESPONSIBLE FOR SAFETY AND SECURITY DURING THE WORK. D. MAINTAIN AREAS ADJACENT TO THE WORK CLEAN AT ALL TIMES. REMOVE DEBRIS REGULARLY, NOT LESS THAN DAILY, OR MORE OFTEN AS REQUIRED.
- FIELD VERIFY EXACT SIZE, EXTENT, TYPE AND LOCATIONS OF PLUMBING, MECHANICAL, ELECTRICAL, FIRE PROTECTION, COMMUNICATIONS AND DATA PENETRATIONS, OPENINGS, ROUGH-IN, AND SIMILAR PROVISIONS
- WITH RESPECTIVE CONTRACTORS PRIOR TO CONSTRUCTION. F. EXISTING CONDITIONS TO BE EXPECTED MAY INCLUDE CONCEALED CONDITIONS. CONTRACTOR SHALL NOTIFY GENERAL CONTRACTOR OF
- UNEXPECTED CONDITIONS THAT WOULD MODIFY SCOPE OF WORK. CONTRACTOR TO OBTAIN WRITTEN AUTHORIZATION BEFORE PROCEEDING. FIELD VERIFY DIMENSIONS, ELEVATIONS, AND CONDITIONS INDICATED ON DRAWINGS PRIOR TO FABRICATION OF MATERIALS AND COMMENCEMENT OF WORK IN AREA OR SEQUENCE. REPORT ANY DISCREPANCIES TO OWNER PRIOR TO PROCEEDING WITH AFFECTED WORK. DO NOT SCALE DRAWINGS,
- PLANS OR DETAILS TO DETERMINE WORKING DIMENSIONS. H. PREPARE EXISTING SURFACES AND SUBSTRATES AS REQUIRED TO FACILITATE AND ACCEPT CONSTRUCTION INDICATED. DO NOT OVERLOAD OR OTHERWISE EXCEED CAPACITY OF STRUCTURE TO CARRY TEMPORARY, CONSTRUCTION, OR PERMANENT LOADS. UNLESS
- OTHERWISE INDICATED DO NOT HANG OR OTHERWISE SUPPORT ANY ITEMS FROM METAL ROOF OR FLOOR DECK. . PATCH AND REPAIR EXPOSED SURFACES AND FINISHES DISTURBED OR AFFECTED. MATCH EXISTING SURFACES WHERE NEW CONSTRUCTION ABUTS
- OR IS ADJACENT TO EXISTING. ALIGN AND FINISH TRANSITIONS TO ACHIEVE SMOOTH, CONTINUOUS, UNIFORM SURFACES TRUE TO LINE AND ELEVATION. K. PATCH AND REPAIR GYPSUM BOARD SURFACES AFFECTED BY THE WORK TO
- ACHIEVE UNIFORM SURFACES TO RECEIVE PAINT. GYPSUM BOARD FINISH INSIDE THE FULFILLMENT CENTER IS LEVEL 3. OUTSIDE THE FULFILLMENT CENTER, IT IS LEVEL 4 UNLESS LEVEL 5 IS SPECIFICALLY
- REQUIRED. M. COORDINATE STAGING AREA AND DUMPSTER LOCATIONS WITH PROPERTY MANAGER.

### DELEGATED DESIGN NOTES


- A. PORTIONS OF THE PROJECT ARE DESIGNATED FOR DELEGATED DESIGN, INCLUDING: - FIRE PROTECTION - FIRE ALARM
- B. DELEGATED DESIGN CONTRACTOR SHALL PREPARE DOCUMENTS, ENGINEERING SERVICES, ENGINEERED SHOP DRAWINGS, ACTION SUBMITTALS, AFFIDAVITS, TESTING RESULTS, AND OTHER INFORMATION REQUIRED FOR REVIEW AND APPROVAL BY AUTHORITIES HAVING JURISDICTION.
- C. DELEGATED DESIGN CONTRACTOR IS RESPONSIBLE TO COORDINATE WITH WORK INDICATED IN THESE DOCUMENTS. NOTIFY ARCHITECT IF CONFLICT ARISES.

### SHEE NO. 03 ARCI A00 A101 A101 A102 A102 A50 A50 09 INTE












GRADE 7 EXIT AT ∕▙╸╸╺╺→К GRADE

FXIT AT

GRADE (E3)

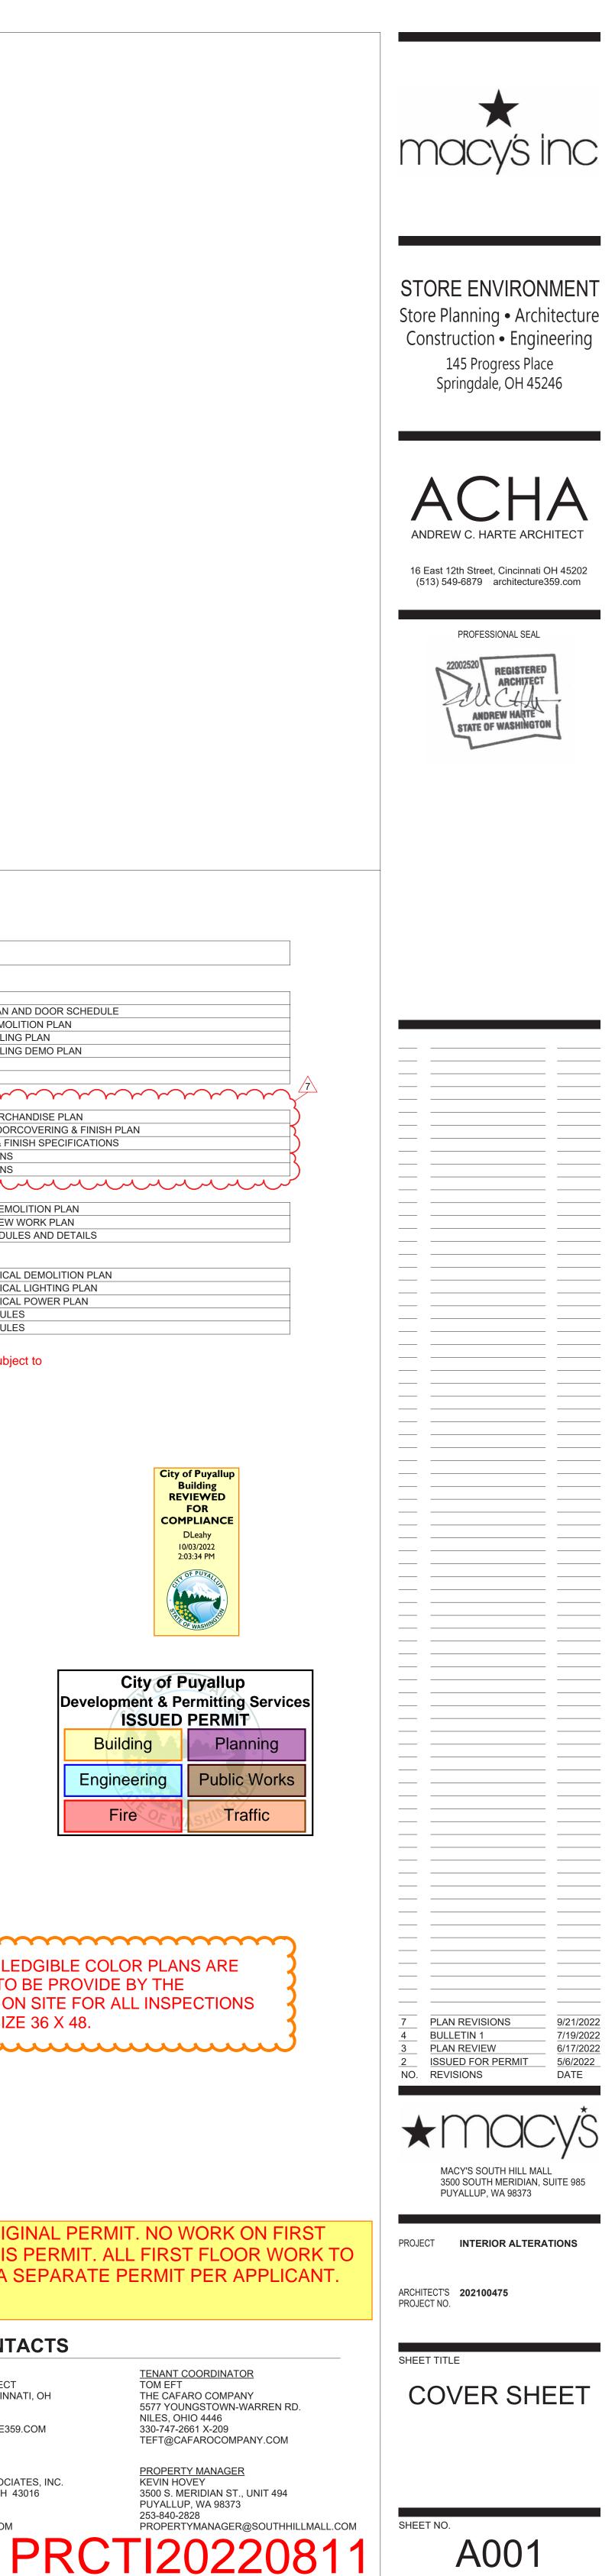

SHEET INDEX

ΕT	
).	SHEET NAME
CHITI	ECTURAL
)1	COVER SHEET
)1	SECOND FLOOR PLAN AND DOOR SCHEDULE
1D	SECOND FLOOR DEMOLITION PLAN
)2	SECOND FLOOR CEILING PLAN
2D	SECOND FLOOR CEILING DEMO PLAN
)1	PARTITION DETAILS
)2	CEILING DETAILS
$\frown$	
ERIC	
1	SECOND FLOOR MERCHANDISE PLAN
3	SECOND FLOOR FLOORCOVERING & FINISH PLAN
1	SECTIONS, DETILS & FINISH SPECIFICATIONS
0	INTERIOR ELEVATIONS
1	INTERIOR ELEVATIONS
	VICAL
·2	2ND FLOOR HVAC DEMOLITION PLAN
-2	2ND FLOOR HVAC NEW WORK PLAN
- 1	HVAC NOTES, SCHEDULES AND DETAILS
ECTR	ICAL
2	2ND FLOOR ELECTRICAL DEMOLITION PLAN
2	2ND FLOOR ELECTRICAL LIGHTING PLAN
2	2ND FLOOR ELECTRICAL POWER PLAN
1	ELECTRICAL SCHEDULES
2	ELECTRICAL SCHEDULES

Reviewed 10/03/2022 DLSubject to

City of Puyallup Building REVIEWED FOR COMPLIANCE DLeahy 10/03/2022 2:03:34 PM

City of Puyallup Development & Permitting Services ISSUED PERMIT				
Building	Planning			
Engineering	Public Works			
Fire OF W	Traffic			

FULL SIZED LEDGIBLE COLOR PLANS ARE REQUIRED TO BE PROVIDE BY THE PERMITTEE ON SITE FOR ALL INSPECTIONS MIN. PLAN SIZE 36 X 48. 

**REVISIONS TO ORIGINAL PERMIT. NO WORK ON FIRST** FLOOR UNDER THIS PERMIT. ALL FIRST FLOOR WORK TO BE DONE UNDER A SEPARATE PERMIT PER APPLICANT.


**PROJECT CONTACTS** 


ARCHITECT: ANDREW C. HARTE, ARCHITECT 16 EAST 12TH STREET, CINCINNATI, OH ATT: BRIAN COFFMAN 513-277-0511 BCOFFMAN@ARCHITECTURE359.COM

MEP ENGINEER: PRATER ENGINEERING ASSOCIATES, INC. 6130 WILCOX RD, DUBLIN, OH 43016 ATT: ANDREW PRATER 614-766-4896 APRATER@PRATERENGR.COM

TENANT COORDINATOR THE CAFARO COMPANY 5577 YOUNGSTOWN-WARREN RD. NILES, OHIO 4446 330-747-2661 X-209 TEFT@CAFAROCOMPANY.COM

PROPERTY MANAGER KEVIN HOVEY 3500 S. MERIDIAN ST., UNIT 494 PUYALLUP, WA 98373 253-840-2828 PROPERTYMANAGER@SOUTHHILLMALL.COM

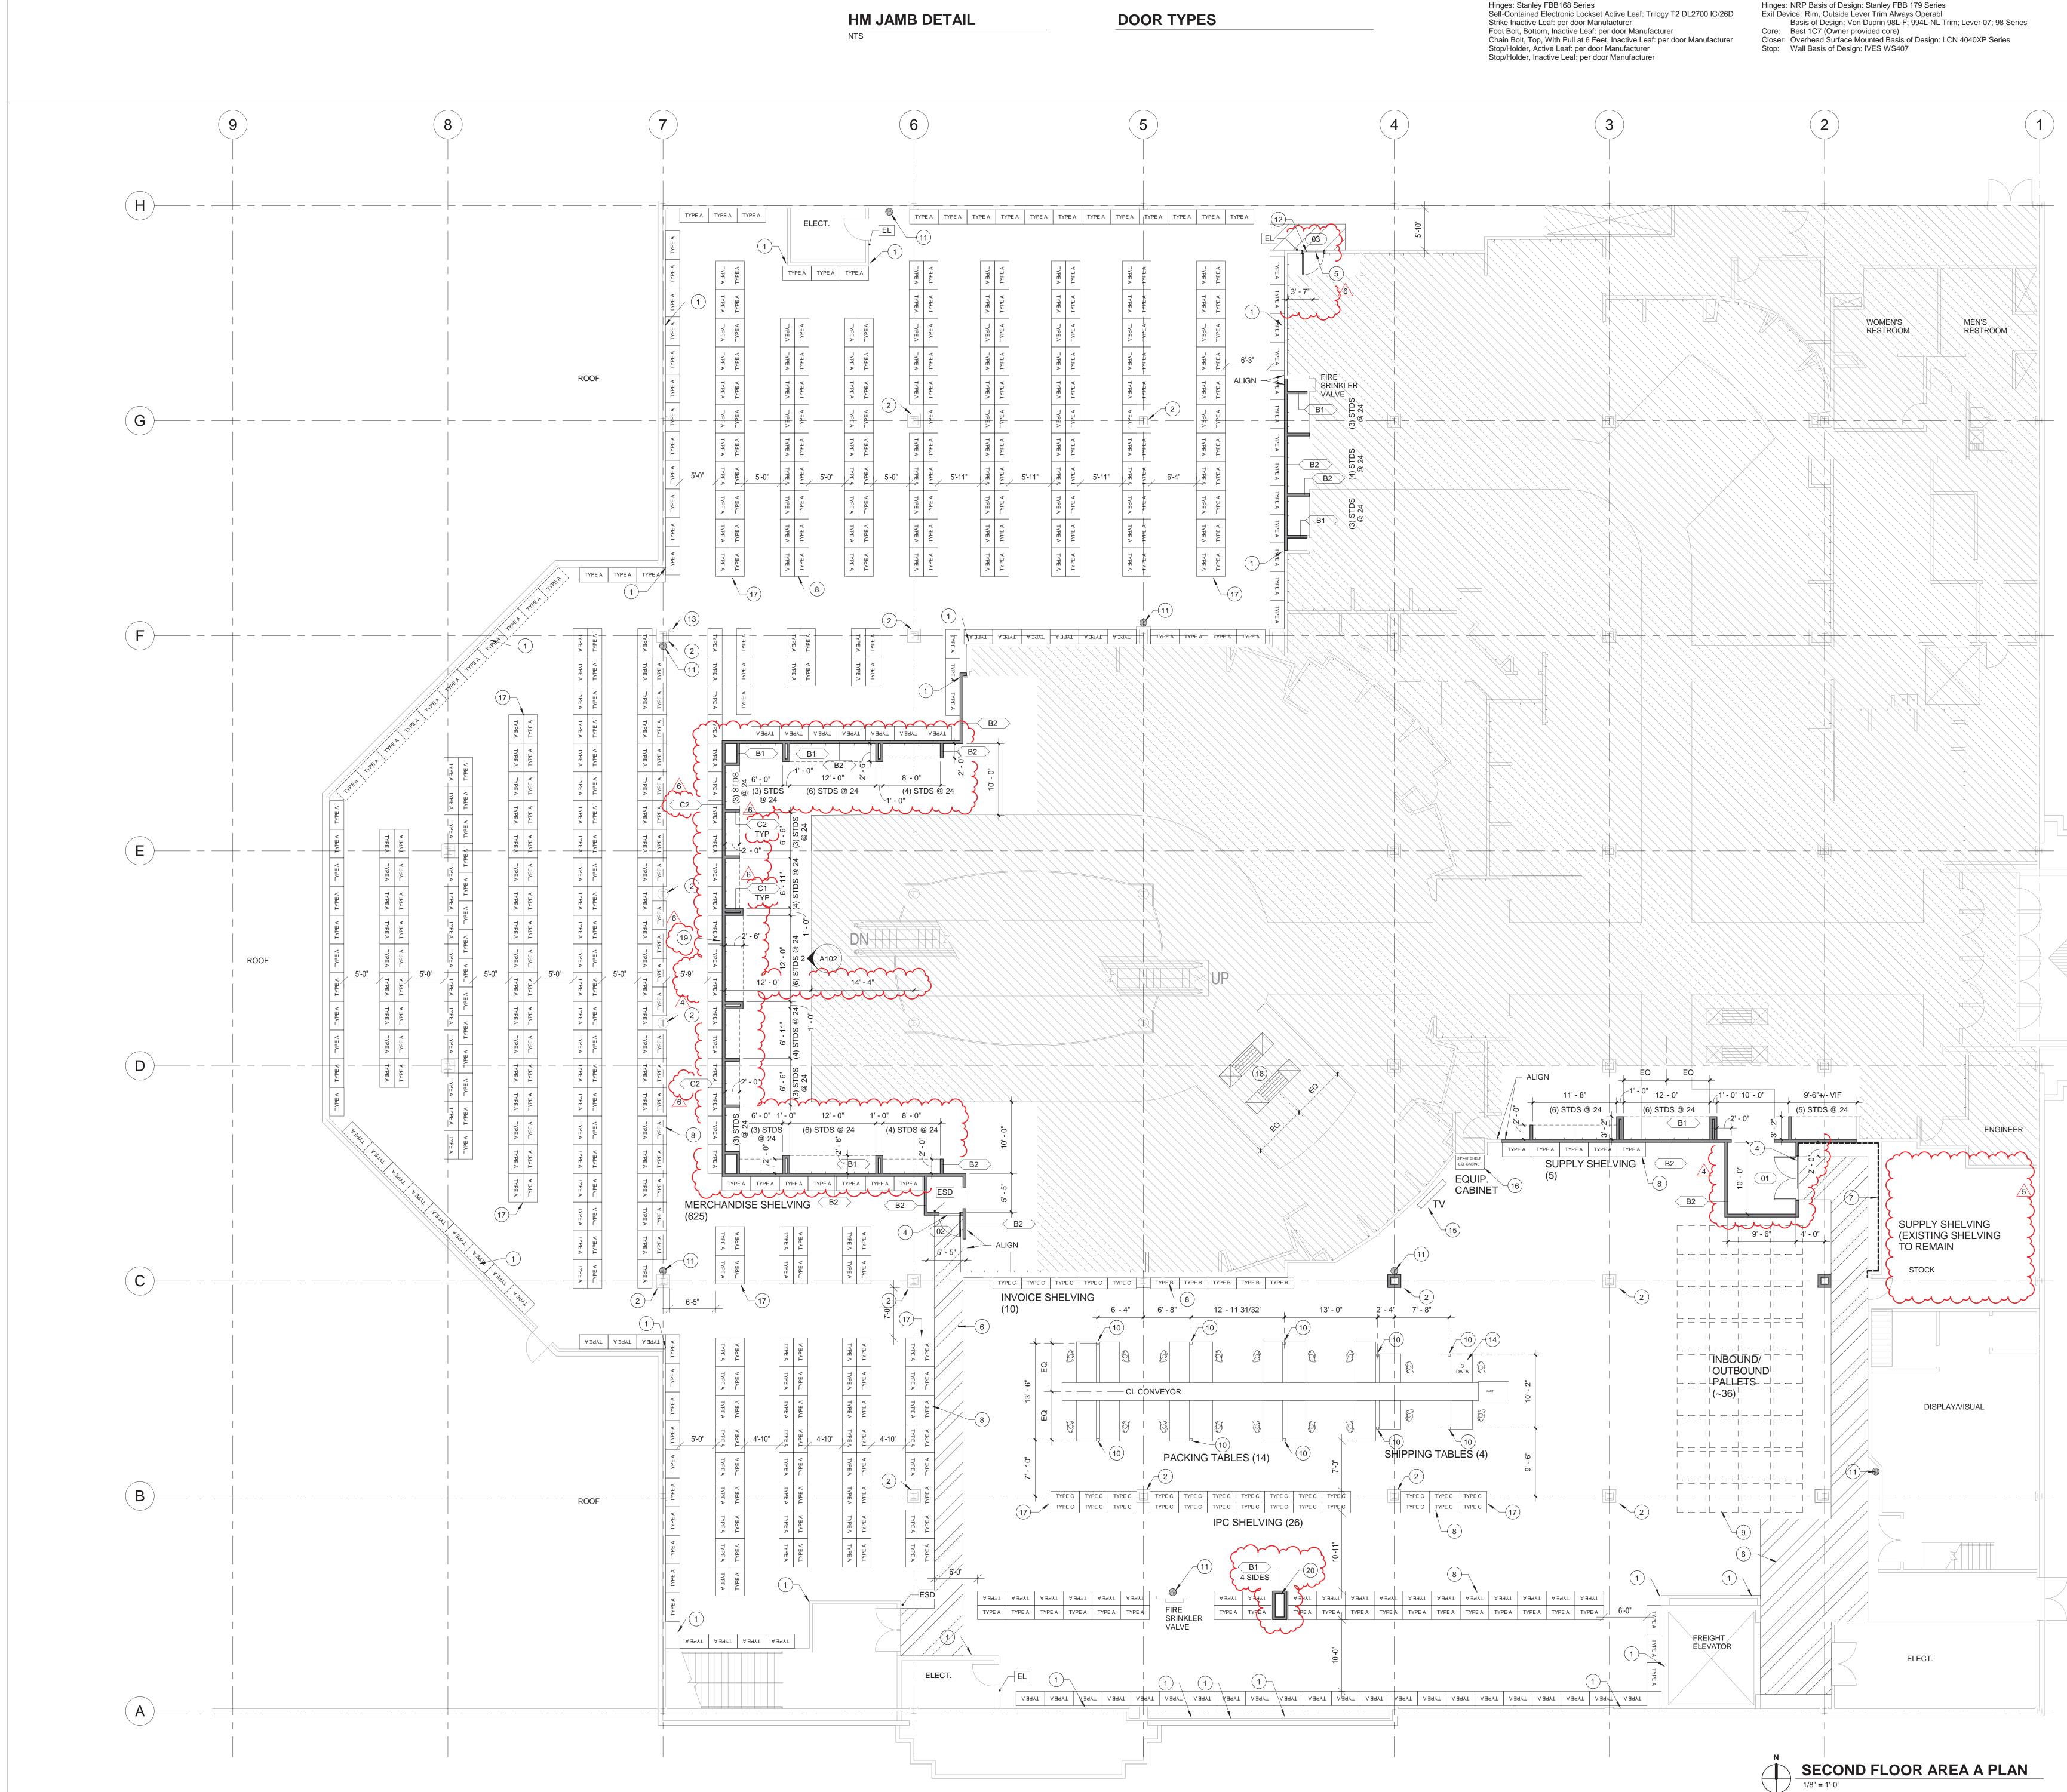

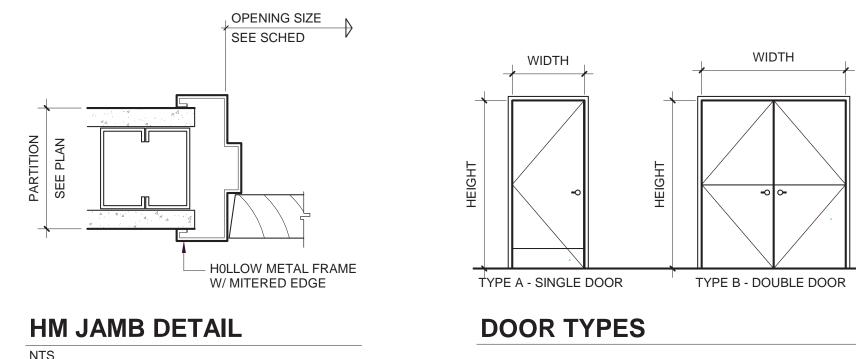


DOOR SCHEDULE									
MARK	FIRE RATING	WIDTH	HEIGHT	TYPE	DOOR MATERIAL	FRAME MATERIAL	FINISH	HARDWARE SET	COMMENTS
01		6' - 0"	7' - 0"	DOUBLE	HM	HM	PT	H1	RHR ACTIVE LEAF
02		3' - 0"	7' - 0"	SINGLE	HM	HM	PT	H2	
03		3' - 0"	7' - 0"	SINGLE	HM	HM	PT	H2	

### \* REFER TO SECTION 08 11 16.26 FOR HOLLOW METAL DOOR SPECIFICATIONS \* REFER TO SECTION 08 14 16.29 FOR SOLID WOOD DOORS SPECIFICATIONS \* REFER TO SECTION 08 71 11.29 FOR DOOR HARDWARE SPECIFICATIONS

HARDWARE SET H1 (DOUBLE DOOR)

HARDWARE SET H2 (EGRESS ONLY)


Hinges: NRP Basis of Design: Stanley FBB 179 Series

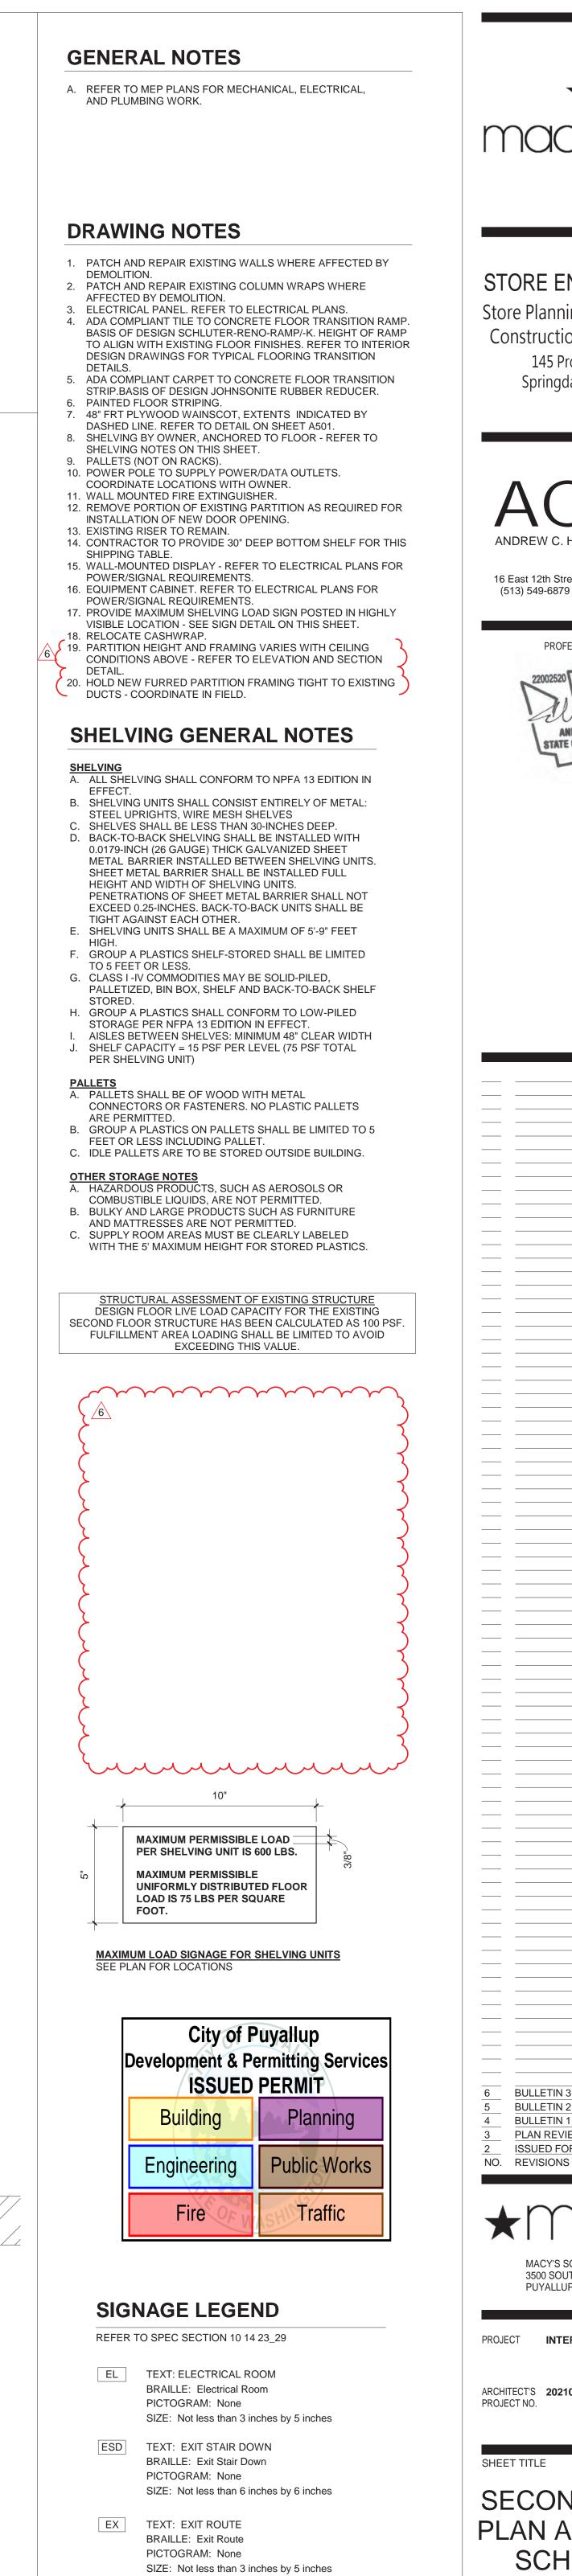



### FIRE PROTECTION DEMOLITION NOTES

A. UNLESS NOTED OTHERWISE, THE EXISTING FIRE PROTECTION SYSTEM IS TO REMAIN, WITHOUT ALTERATION, DURING DEMOLITION.

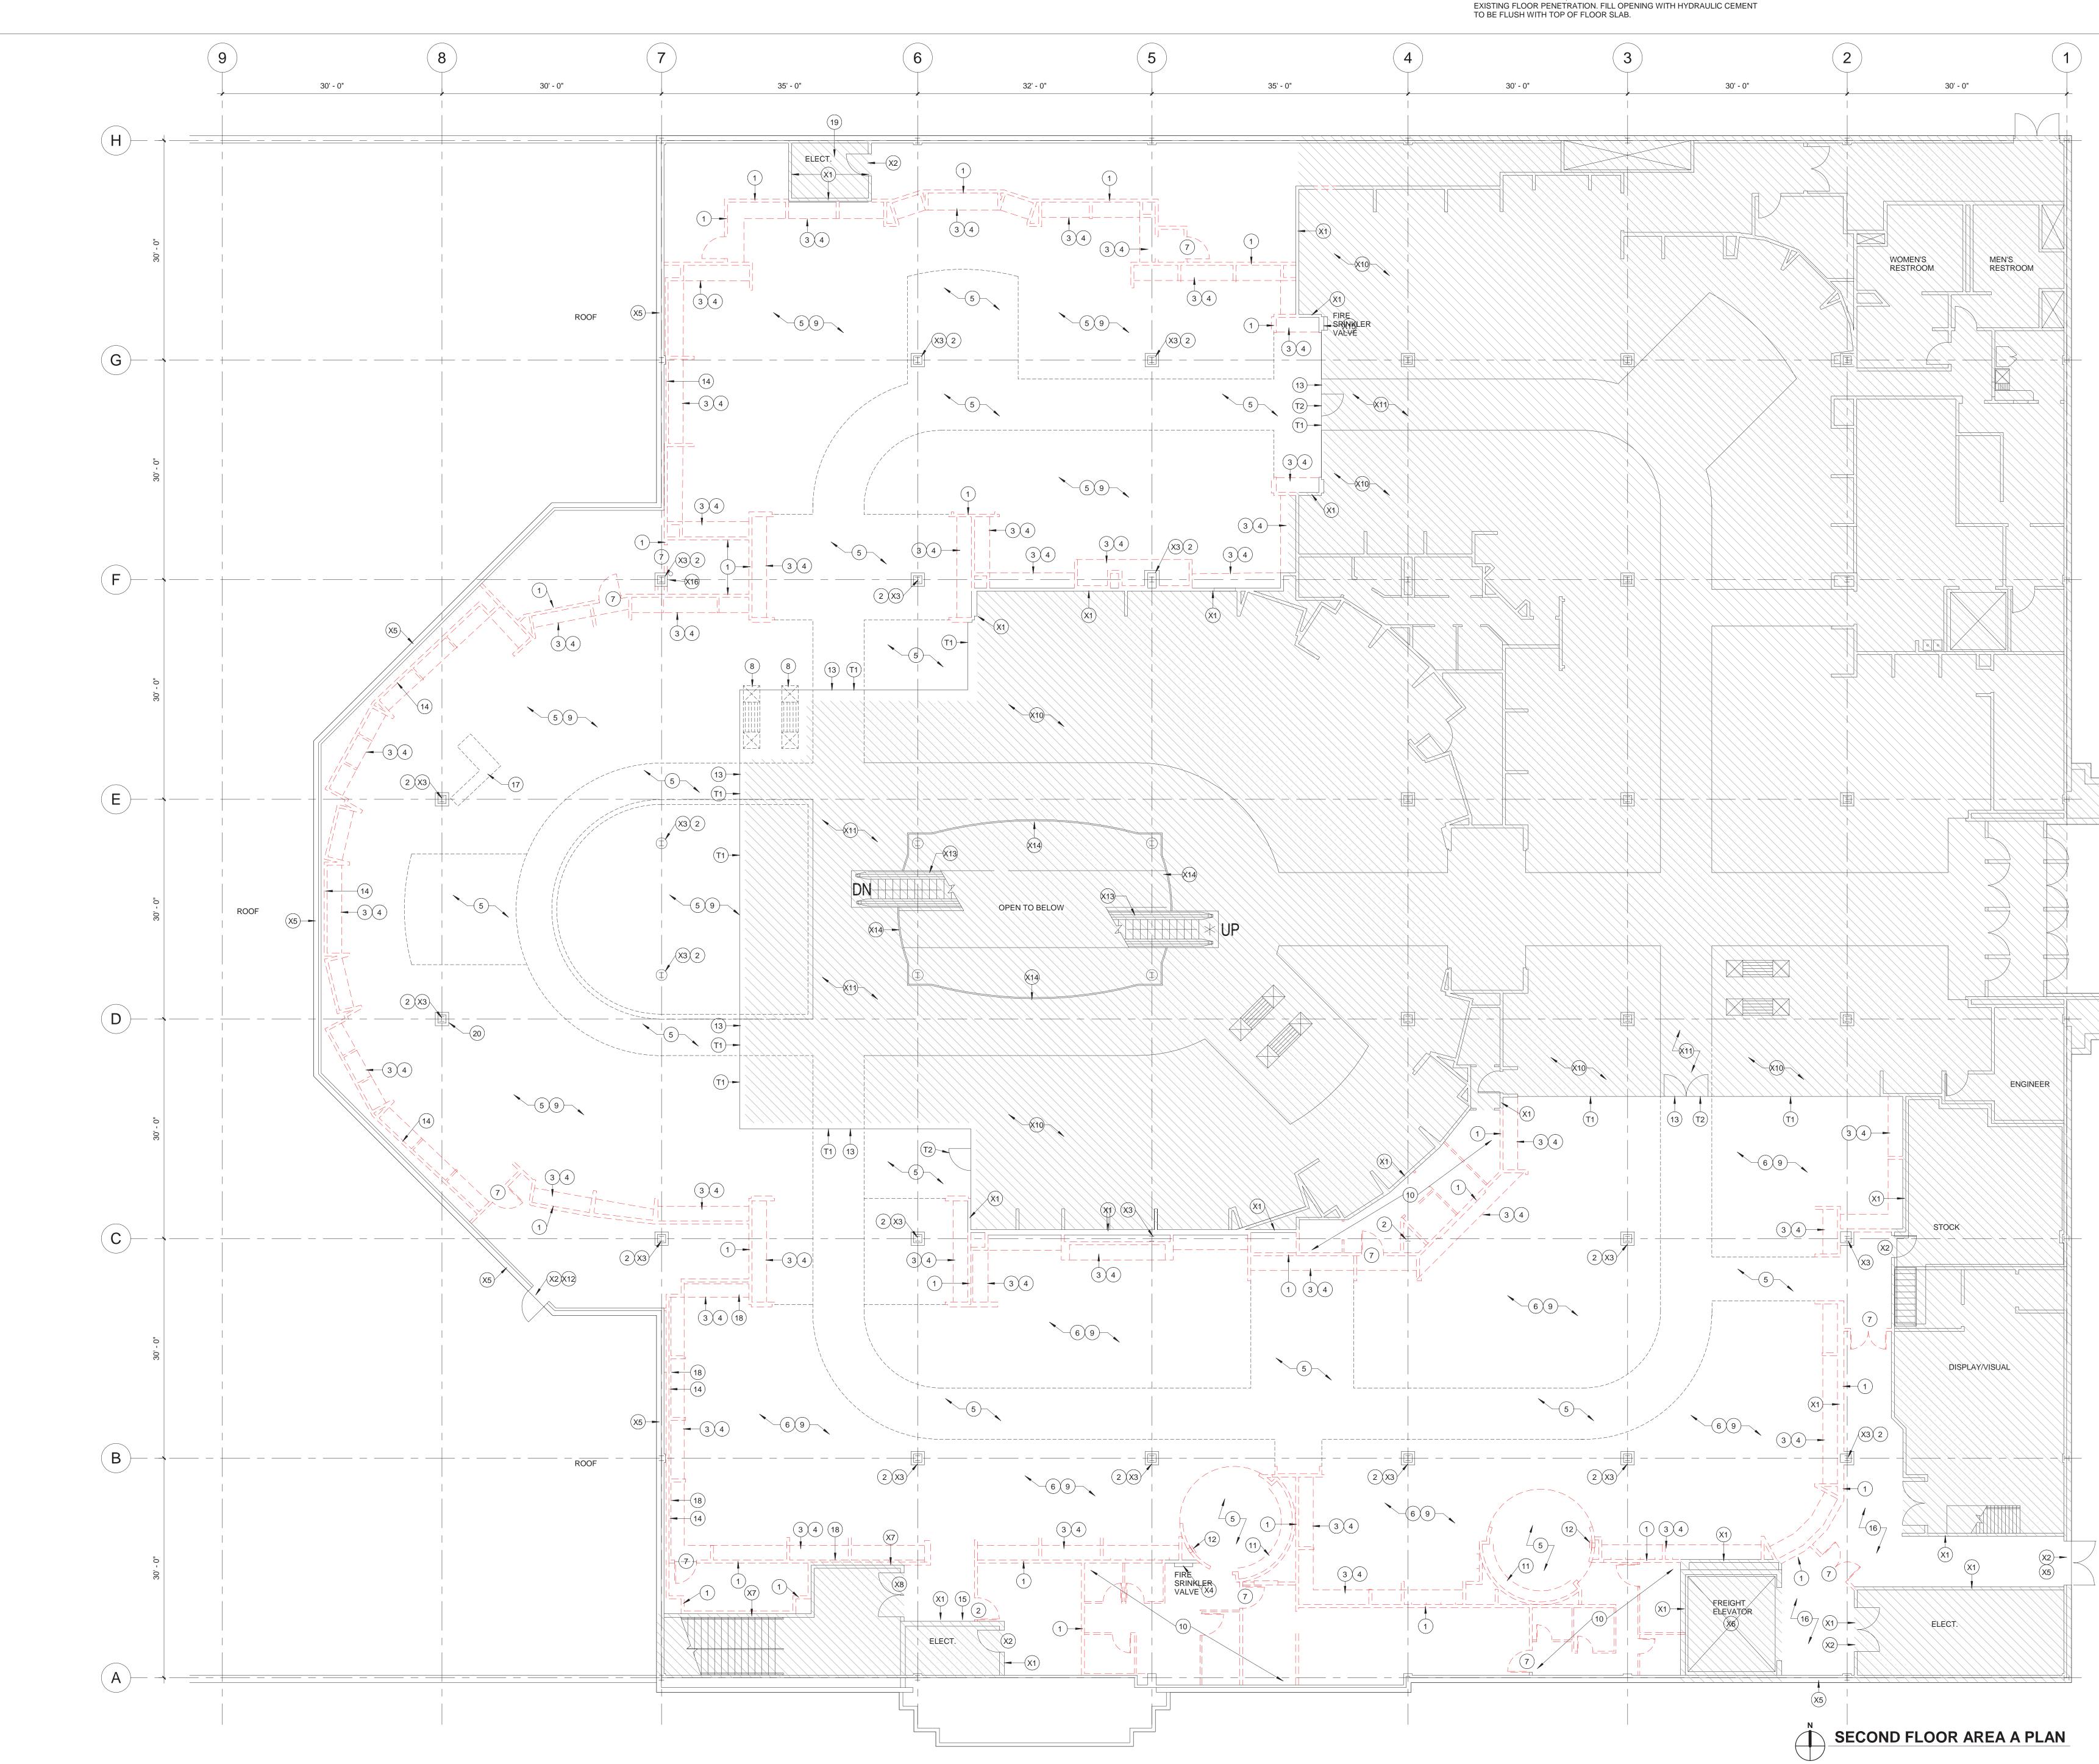

### PLUMBING DEMOLITION NOTES


- A. IN GENERAL, ALL PLUMBING SYSTEMS SHALL REMAIN FOR DEMOLITION IN THE TENANT IMPROVEMENT PACKAGE. COORDINATE WITH THE PROJECT MANAGER TO MAINTAIN ALL CONCEALED PIPING INCLUDING, BUT NOT LIMITED TO: DCW. DHW. CONDENSATE, SANITARY, VENTING, FIRE PROTECTION, NATURAL GAS, ETC. CONCEALED IN WALLS FEEDING ADJACENT SPACES TO REMAIN AND OTHER FLOORS. FIELD VERIFY, PROTECT AND MAINTAIN ANY SYSTEM COMPONENTS FEEDING THESE B. DEMOLITION CONTRACTOR TO FIELD VERIFY AND PROTECT ANY
- CONCEALED PIPING INCLUDING, BUT NOT LIMITED TO; DCW, DHW, CONDENSATE, SANITARY, VENT FIRE PROTECTION, ETC. THAT MAY BE CONCEALED WITHIN WALLS BEING DEMOLISHED.


EQUIPMENT.


A. DEMOLITION CONTRACTOR TO FIELD VERIFY AND PROTECT ANY CONCEALED DUCTWORK INCLUDING, BUT NOT LIMITED TO; SUPPLY AIR RETURN AIR, RESTROOM EXHAUST, GREASE EXHAUST, DISHWASHER EXHAUST, ETC. THAT MAY BE CONCEALED WITHIN WALLS BEING DEMOLISHED. B. MAINTAIN ALL THERMOSTATS AND TEMPERATURE SENSORS. WHERE DEVICE IS LOCATED ON WALLS BEING DEMOLISHED, THE CONTRACTOR SHALL REMOVE DEVICE FROM WALL, COIL THE SLACK CONTROL CABLE AND SUPPORT DEVICE AT 9'-0" AFF. MAINTAIN CONTROL OF ASSOCIATED

### **ELECTRICAL DEMOLITION NOTES**


- A. UNLESS NOTED OTHERWISE, FIRE ALARM SYSTEM IS EXISTING TO REMAIN. MAINTAIN AND PROTECT ACTIVE DEVICES TO PREVENT INADVERTENT BUILDING EVACUATION. B. ANY DEMOLISHED FIRE ALARM DEVICES NOT RELOCATED SHALL BE STORED AND TURNED OVER TO OWNER UPON PROJECT COMPLETION
- AND OBTAIN A RECEIPT. C. DEMOLISH WIRING DEVICES IN WALLS BEING DEMOLISHED. UNLESS NOTED OTHERWISE, REMOVE ALL WIRE AND CONDUIT FROM DEMOLISHED WIRING DEVICES BACK TO SOURCE OR NEXT UPSTREAM EQUIPMENT TO REMAIN. MAKE JUNCTIONS AND EXTEND CIRCUITRY TO MAINTAIN POWER
- AND CONTROL TO ALL DOWNSTREAM EQUIPMENT TO REMAIN. REMOVE ALL ASSOCIATED UNUSED PATHWAYS AND HARDWARE. D. DEMOLISH DATA/COMMUNICATION OUTLETS IN WALLS BEING DEMOLISHED. ANY DEMOLISHED DATA/COMMUNICATION OUTLETS SHALL HAVE THE ASSOCIATED CABLING DEMOLISHED BACK TO THE SOURCE.
- E. COORDINATE WITH THE PROJECT MANAGER TO MAINTAIN ALL DATA/ COMMUNICATION/ SECURITY/FIRE ALARM/LIGHTING AND POWER REQUIREMENTS CONCEALED IN WALLS FEEDING ADJACENT SPACES TO REMAIN AND OTHER FLOORS. FIELD VERIFY, PROTECT AND MAINTAIN ANY SYSTEM COMPONENTS FEEDING THESE AREAS. F. DEMOLISH ALL POKE-THROUGH DEVICES WITHIN THE EXTENT OF DEMOLITION. DEMOLISHED POKE THROUGH DEVICES TO HAVE FLOOR PENETRATION REPAIRED. IN THE CEILING SPACE OF THE FLOOR BELOW,
- PROVIDE AND SECURE A METAL COVER PLATE TO "CLOSE" THE EXISTING FLOOR PENETRATION. TO ACT AS DOWEL ROD(S), PROVIDE TWO (2) 1/4" X 1-1/4" TAPCON SCREWS, LOCATED 180 DEGREES APART AT MID-DEPTH OF
- EXISTING TO REMAIN. IF LOCAL LIGHTING CONTROLS ARE DEMOLISHED THEN PROVIDE MANUAL CONTROL OF EXISTING LIGHTING VIA CIRCUIT BREAKER IN SOURCE PANELBOARD. H. DEMOLISH UNDER-SHELF AND VALANCE LIGHTING FIXTURES AT WALLS BEING DEMOLISHED. REMOVE ALL WIRE AND CONDUIT FROM DEMOLISHED LIGHTING FIXTURES BACK TO SOURCE OR NEXT UPSTREAM LIGHTING FIXTURE TO REMAIN. MAKE JUNCTIONS AND EXTEND CIRCUITRY TO MAINTAIN POWER AND CONTROL TO ALL DOWNSTREAM LIGHTING FIXTURES TO REMAIN. REMOVE ALL ASSOCIATED UNUSED PATHWAYS AND HARDWARE. I. ALL PROPOSED TEMPORARY WALLS TO STOP AT BOTTOM OF CEILING. COORDINATE WITH ARCHITECT FOR ANY LIGHTING FIXTURES THAT WILL
- BE OBSTRUCTED BY PROPOSED TEMPORARY WALL. DEMOLISH LIGHTING FIXTURE AS DIRECTED IN THE FIELD. J. DEMOLISH ALL SURFACE RACEWAY ON WALL TO BE DEMOLISHED. REMOVE ALL WIRE AND CONDUIT FROM THE DEMOLISHED SURFACE RACEWAY BACK TO ITS SOURCE. K. PROTECT AND MAINTAIN ALL ELECTRCIAL PANELBOARDS, LIGHTING
- CONTROL RELAY PANELS, HVAC CONTROL PANELS, TELE/DATA RACKS, AND ASSOCIATED EQUIPMENT ROOMS.

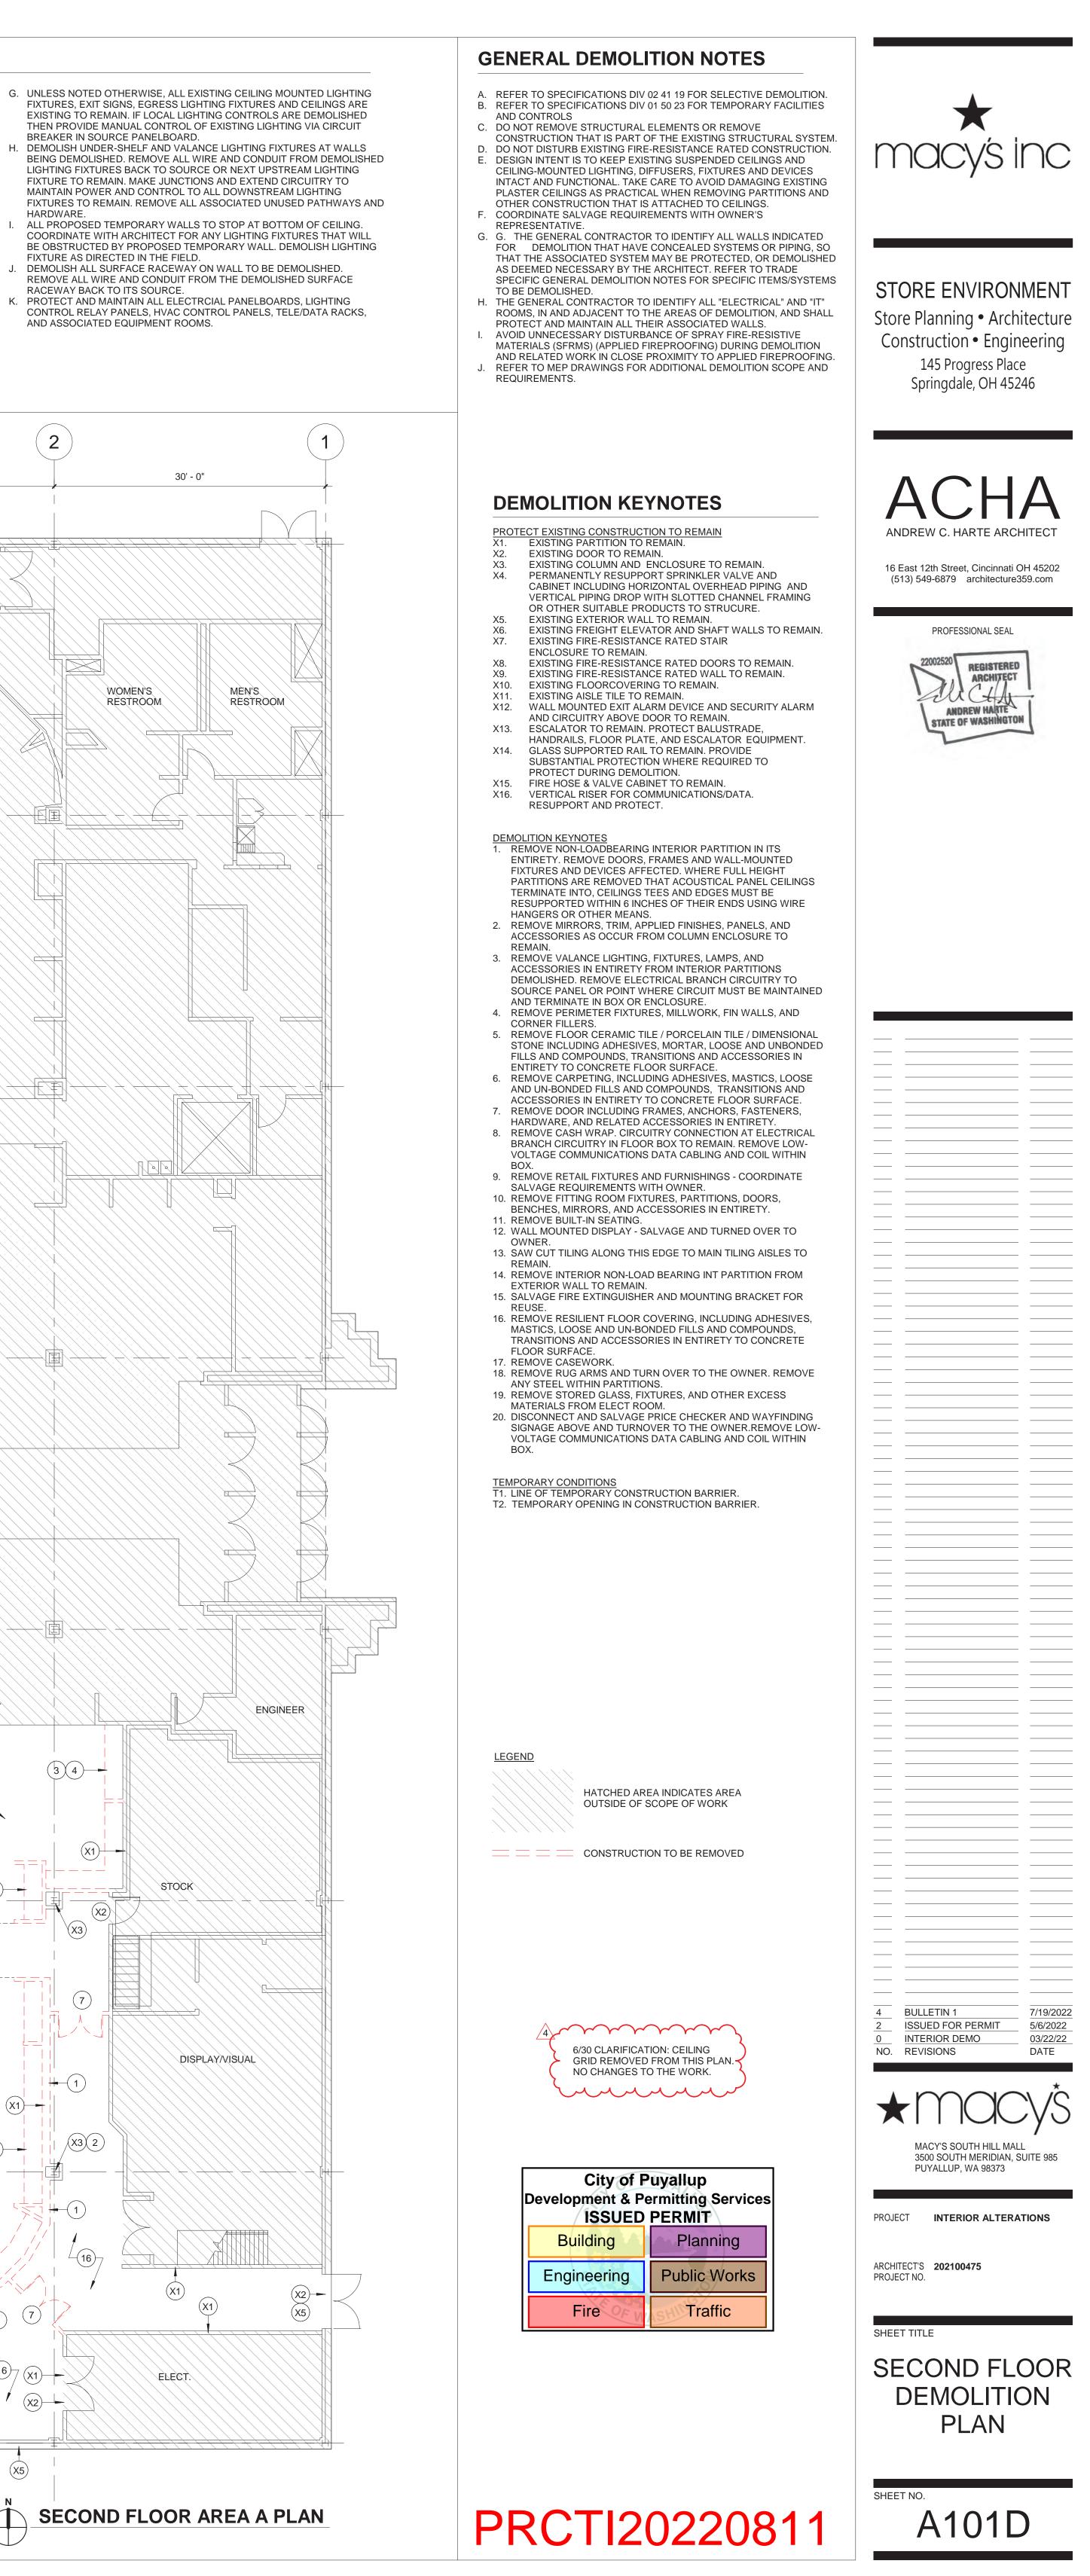

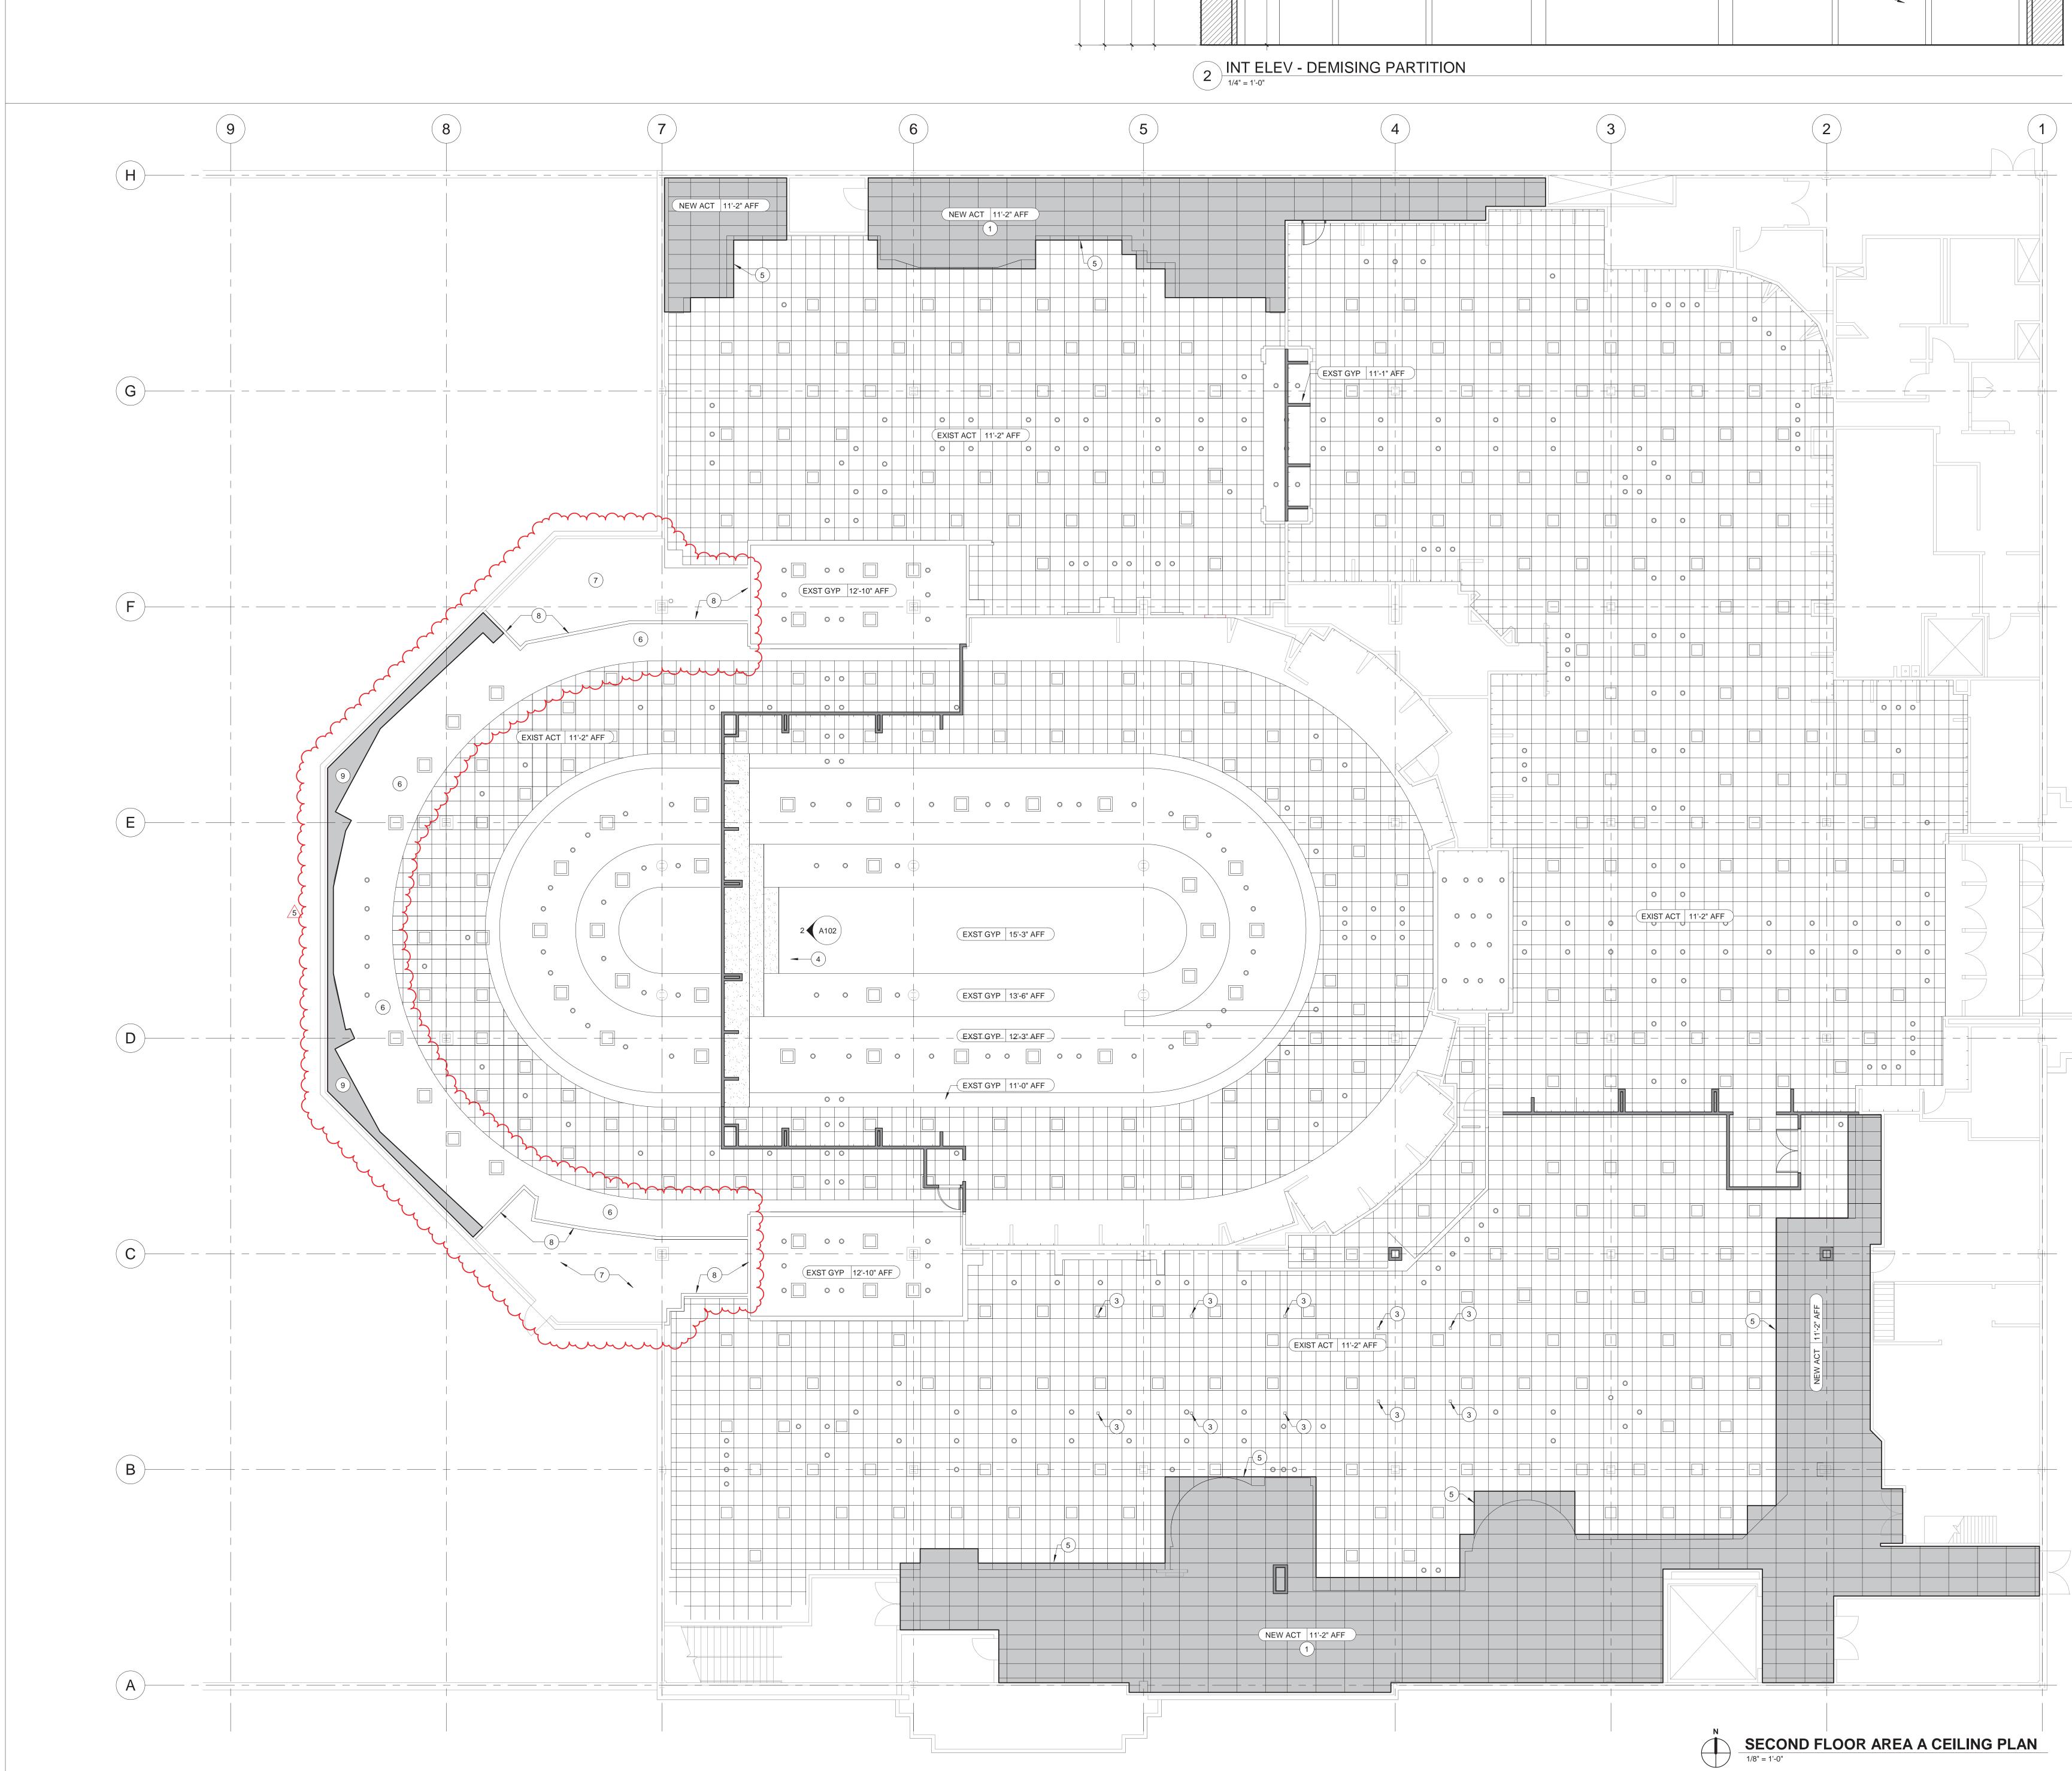

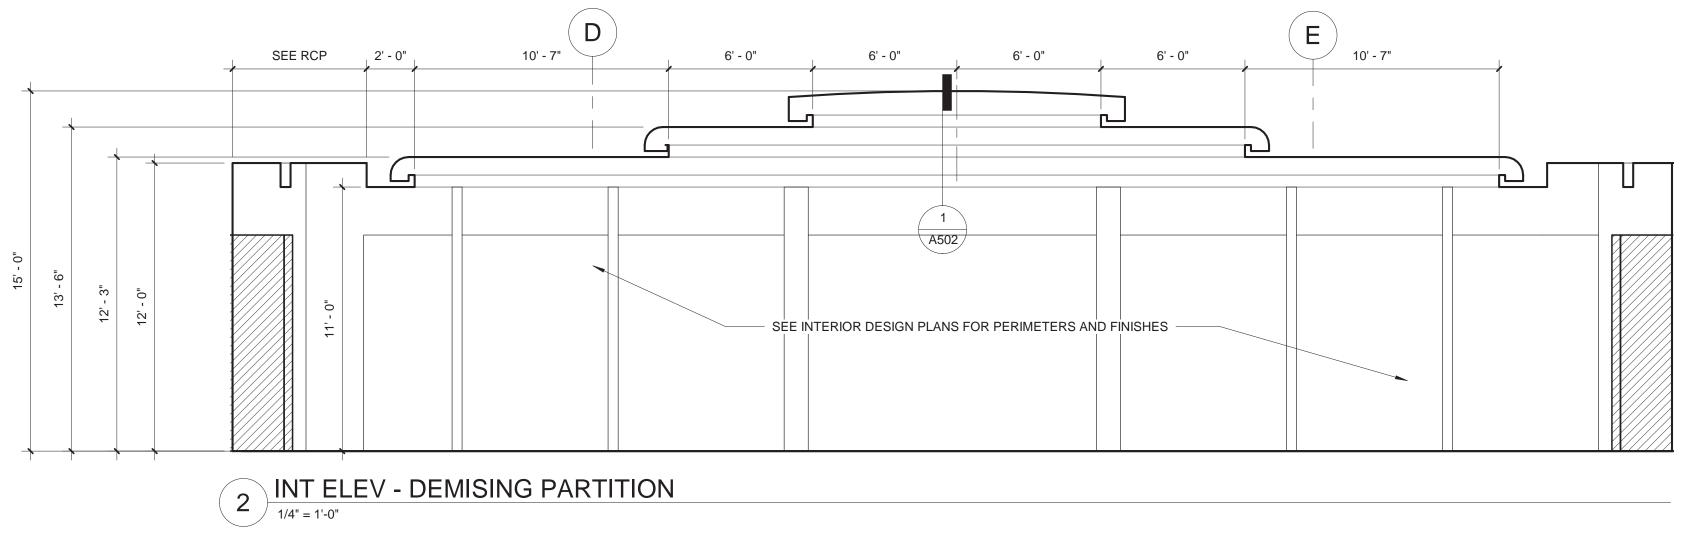

<ul> <li>A. REFER TO MEP PLANS FOR MECHANICAL, ELECTRICAL, AND PLUMBING WORK.</li> <li>B. SPINKLER WORK IS DELEGATED DESIGN UNDER SEPARATE PERMIT.</li> <li>C. REFER TO SHEET A502 FOR CEILING DETAILS AND NOTES.</li> <li>D. PATCH EXISTING CEILINGS AS REQUIRED AT AREAS AFFECTED BY NEW WORK. PAINT PT-1 TO MATCH EXISTING. REFER TO INTERIOR DESIGN DRAWINGS FOR FINISH LEGEND.</li> </ul>	macys inc
<ul> <li>CELLING NOTES</li> <li>24x48 ACT CEILING. REFER TO SPECIFICATIONS. REFER TO ETAILS ON SHEET A502.</li> <li>CYSUM BULKHEAD. SEE DETAIL ON SHEET A502.</li> <li>POWER POLE. REFER TO ELECTRICAL PLANS.</li> <li>NEW GYPSUM BOARD TIERED CEILING TO MATCH EXISTING ADJACENT CEILING - SEE ELEVATION AND DETAILS. PAINT NEW CEILING AND COVES TO MATCH EXISTING.</li> <li>TRANSITION FROM EXISTING CEILING SYSTEM TO NEW CEILING SYSTEM - FIELD COORDINATE TO ALIGN WITH EXISTING GRID TEES TO REMAIN. ALIGN NEW GRID SYSTEM TEES WITH EXISTING GRID. PROVIDE SEISMIC SLEEVE AT TRANSITION FROM EXISTING CEILING SYSTEM TO NEW CEILING SYSTEM - REFER TO SPECS FOR ADDITIONAL REQUIREMENTS.</li> <li>EXISTING GYPSUM BOARD SOFFIT TO REMAIN.</li> <li>COPEN TO STRUCTURE ABOVE - PROVIDE NEW BRACING AT 48° OC MAX. REFER TO BULKHEAD DETAILS ON SHEET A502.</li> <li>SHADED AREA INDICATES EXTENT OF NEW INFILL BETWEEN EXISTING SOFFIT AND EXTERIOR WALL. PROVIDE NEW METAL FRAMING AND GYPSUM BOARD TO MATCH ADJACENT SOFFIT.</li> </ul>	STORE ENVIRONMENT Store Planning • Architectur Construction • Engineering 145 Progress Place Springdale, OH 45246
	(513) 549-6879 architecture359.com
City of Puyallup Development & Permitting Services ISSUED PERMIT Building Planning	
Engineering       Public Works         Fire       Traffic	
	2       ISSUED FOR PERMIT       5/6/202         NO.       REVISIONS       DATE         Image: Constraint of the second se
PRCTI20220811	SHEET TITLE SECOND FLOOF CEILING PLAN SHEET NO. A102

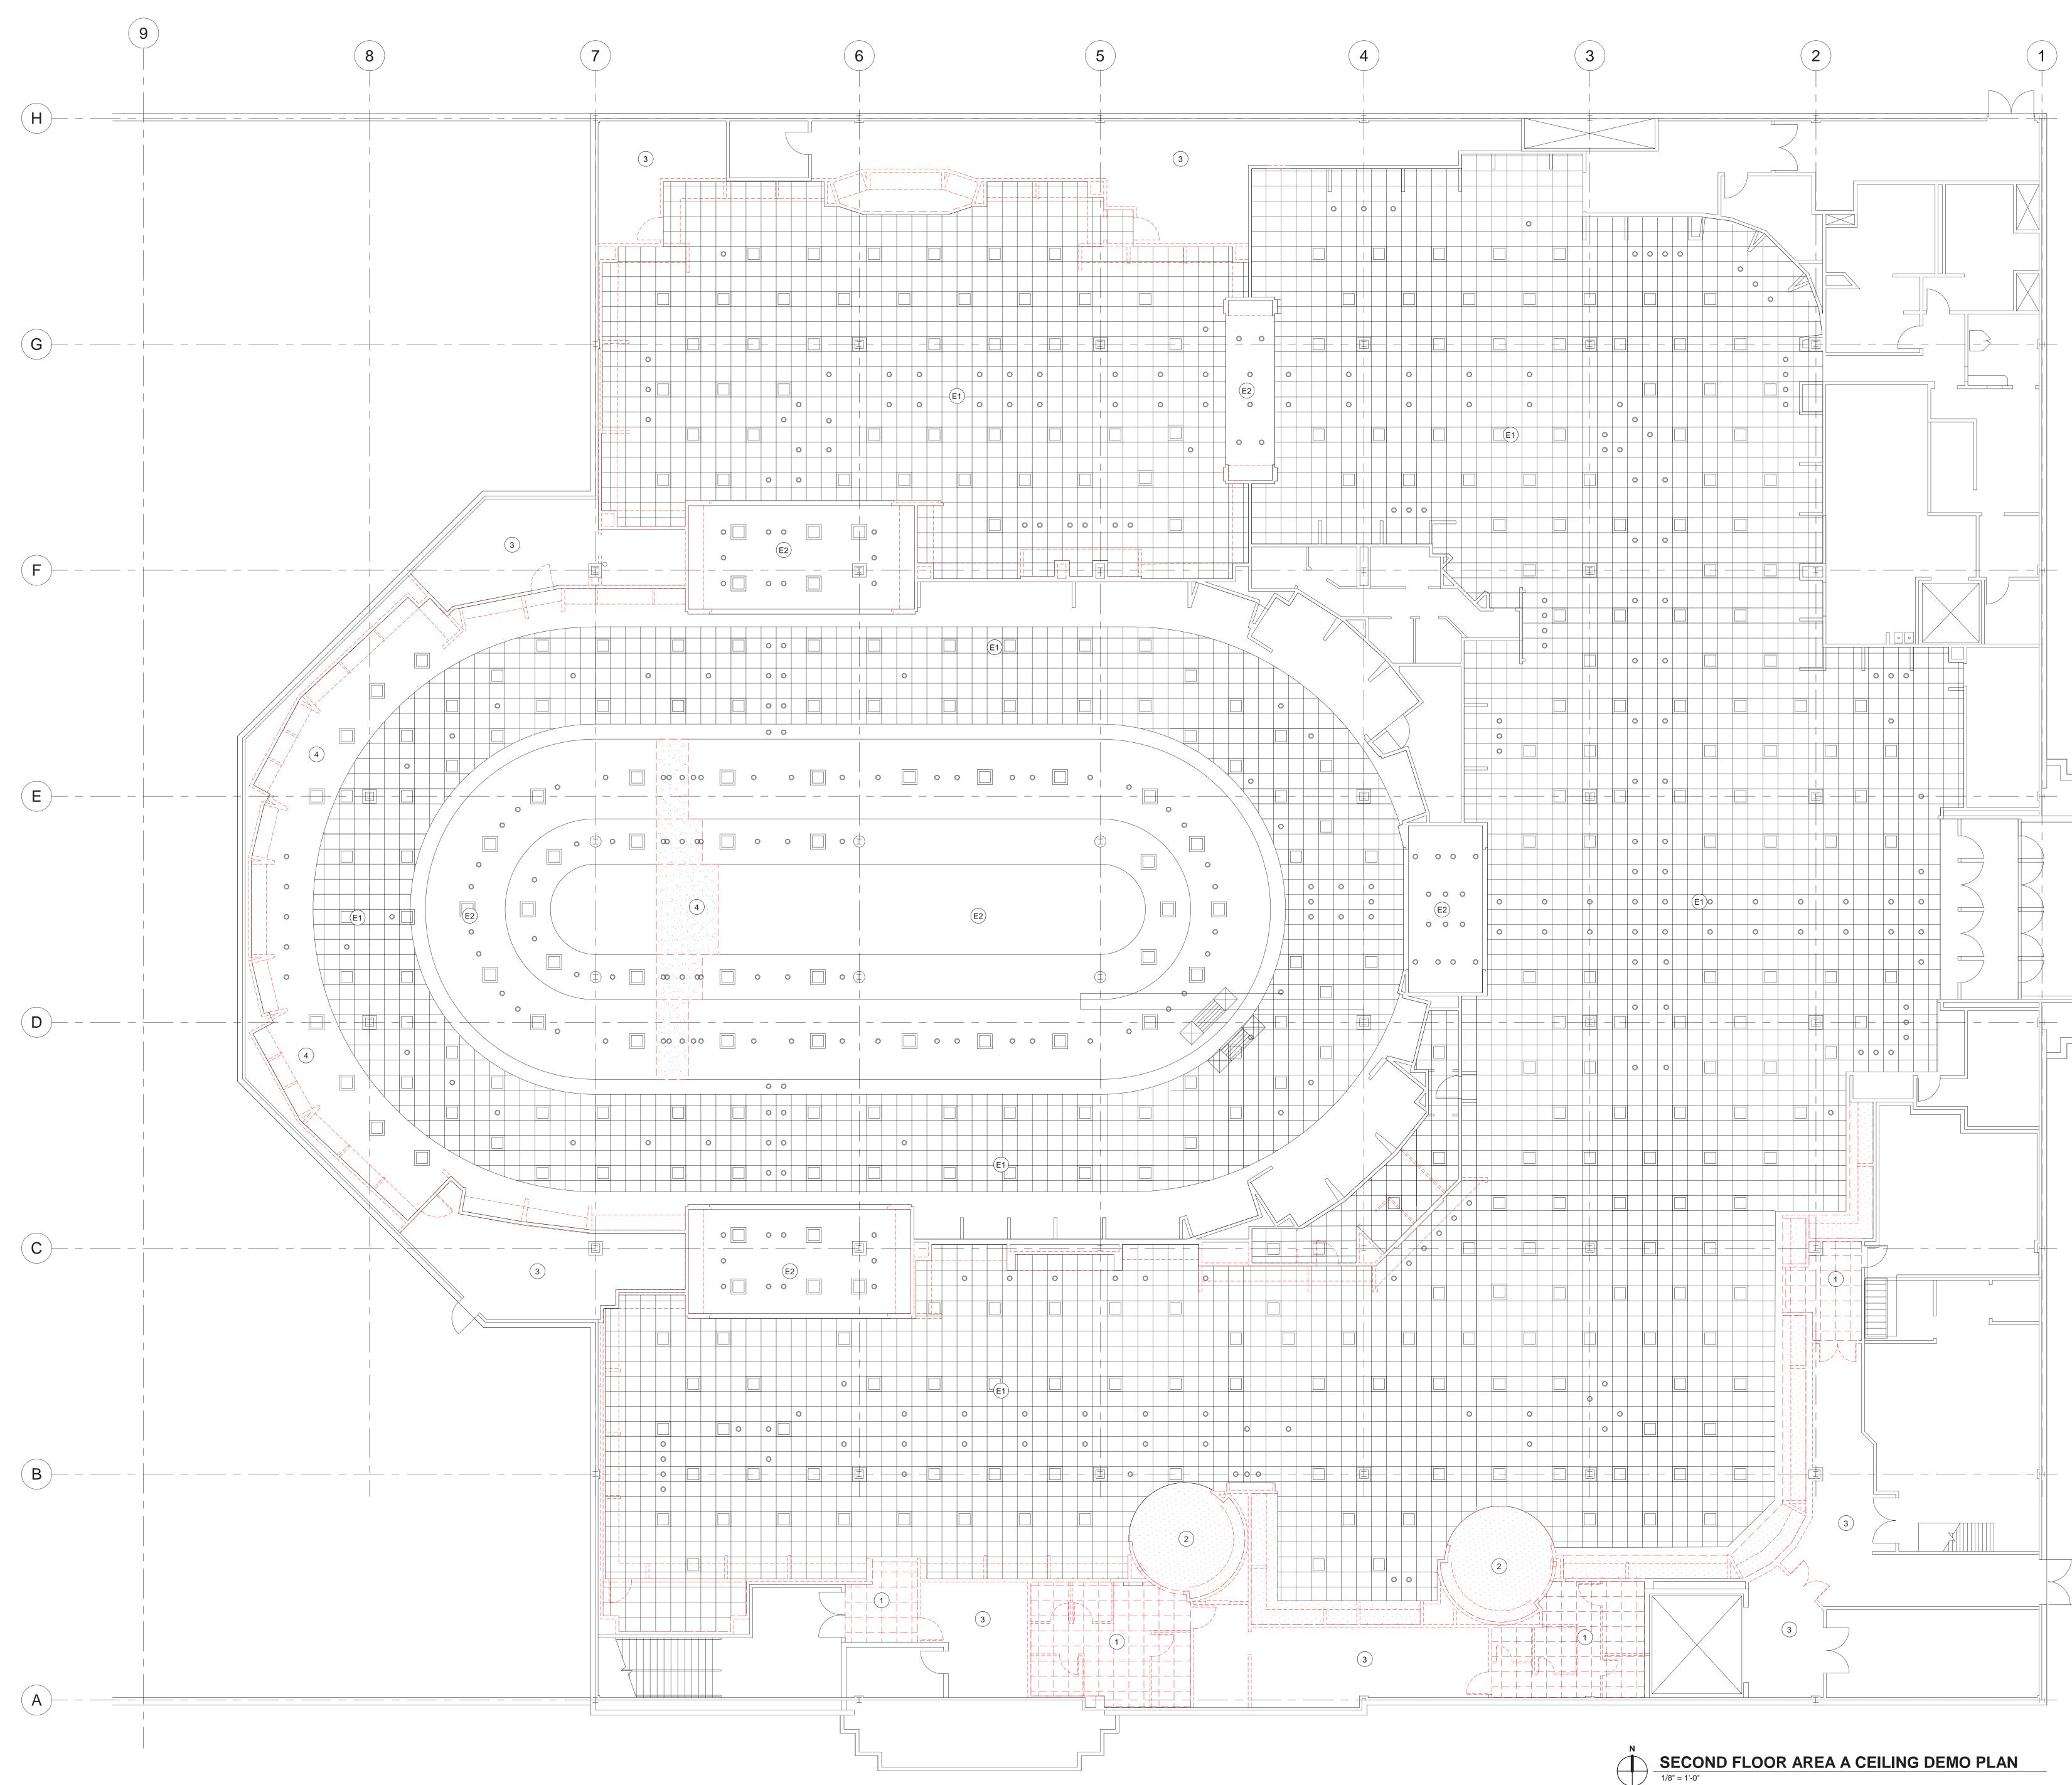

### **GENERAL DEMOLITION NOTES**

A. REFER TO MEP PLANS FOR MECHANICAL, ELECTRICAL, AND PLUMBING DEMOLITION. B. SPINKLER WORK IS DELEGATED DESIGN UNDER

### **DEMOLITION NOTES**

SEPARATE PERMIT.

- DEMOLISH EXISTING ACT CEILING AND SUPPORTS.
   DEMOLISH EXISTING GYPSUM BOARD CEILING AND SUPPORTS.
- 3. AREA OPEN TO DECK. REFER TO MEP DRAWINGS FOR LIGHTING AND HVAC DEMOLITION SCOPE. 4. REMOVE PORTION OF EXISTING TIERED GYPSUM CEILING AS
- REQUIRED FOR INSTALLATION OF NEW PARTITION AND NEW CEILING. 5. REMOVE EXISTING GYPSUM BOARD CEILING.

### **EXISTING CONDITIONS**

E1. EXISTING ACT TO REMAIN. E2. EXISTING GYPSUM CEILING TO REMAIN. PROVIDE DIAGONAL BRACING AS REQUIRED WHERE ADJACENT CONSTRUCTION HAS BEEN REMOVED.




### STORE ENVIRONMENT Store Planning • Architecture Construction • Engineering 145 Progress Place Springdale, OH 45246




16 East 12th Street, Cincinnati OH 45202 (513) 549-6879 architecture359.com




2	ISSUED FOR PERMIT	5/6/2022		
NO.	REVISIONS	DATE		
*	MACY'S SOUTH HILL MALL 3500 SOUTH MERIDIAN, SUITE 985 PUYALLUP, WA 98373			
PROJE	PROJECT INTERIOR ALTERATIONS			
ARCHITECT'S <b>202100475</b> PROJECT NO.				
	SHEET TITLE			
SECOND FLOOR CEILING DEMO PLAN				
SHEE	SHEET NO.			
A102D				

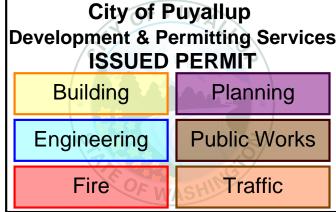


Development & Permitting Services				
Building	Planning			
Engineering	Public Works			
Fire OF W	Traffic			

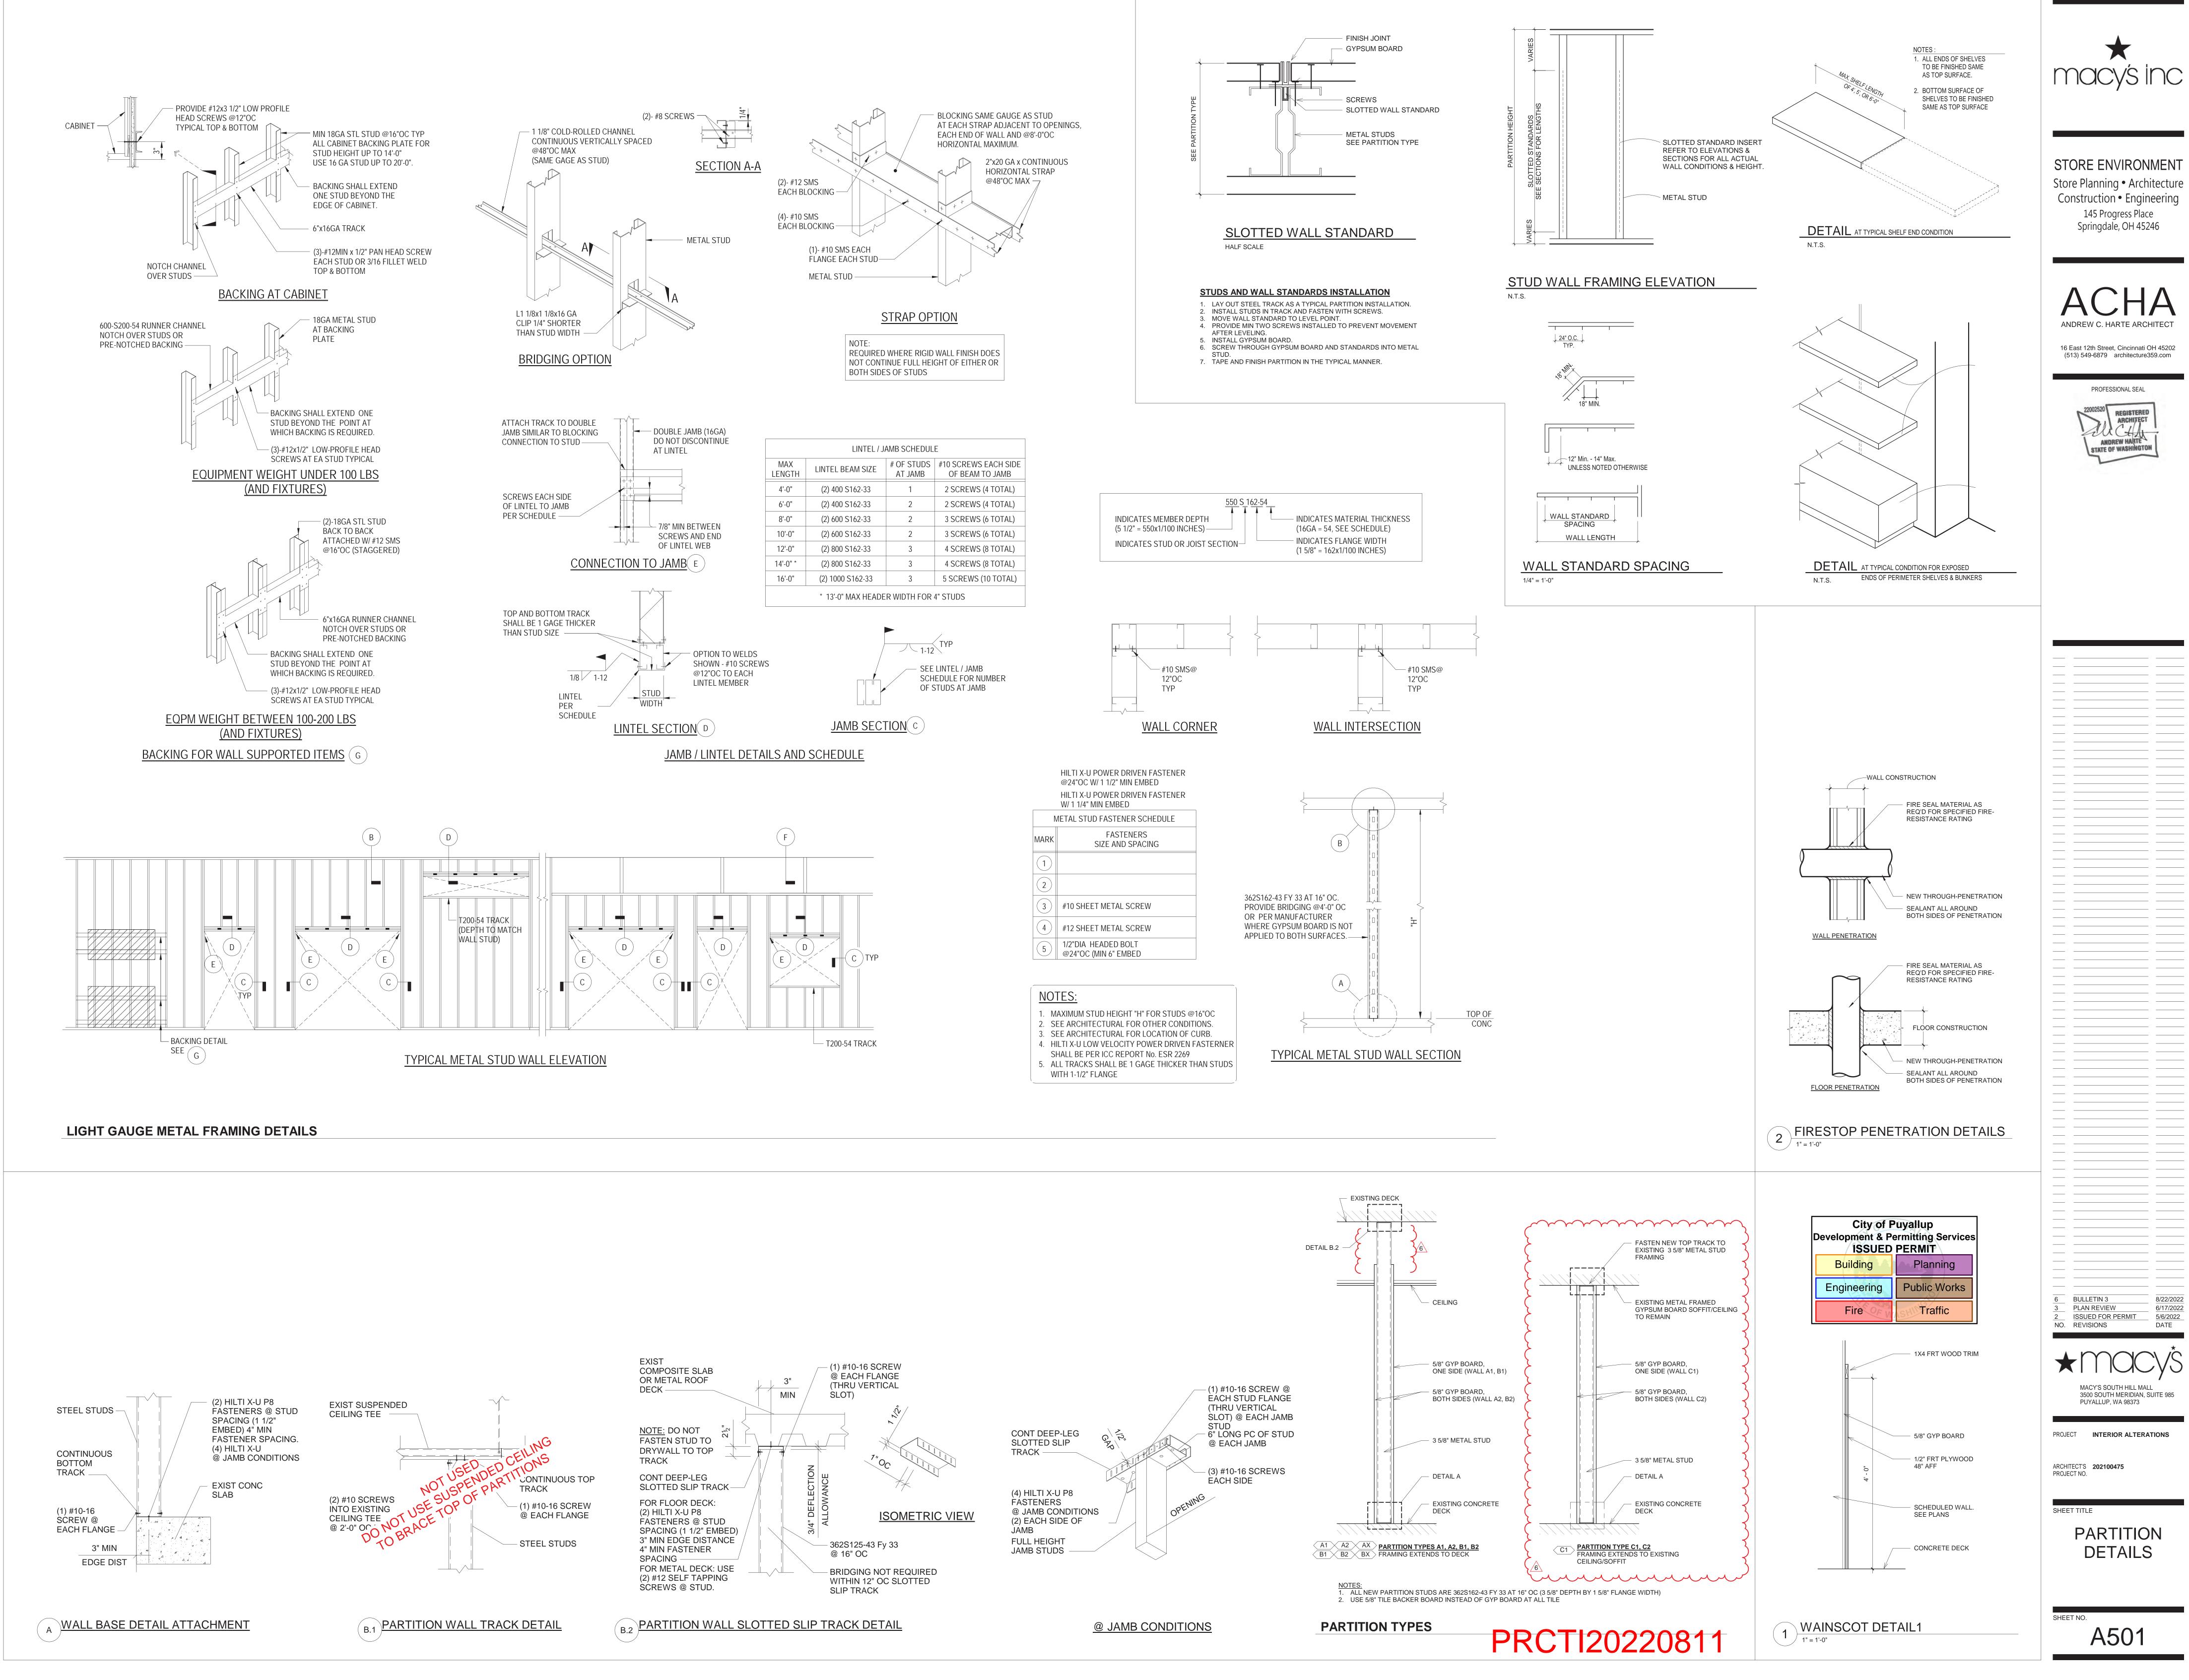


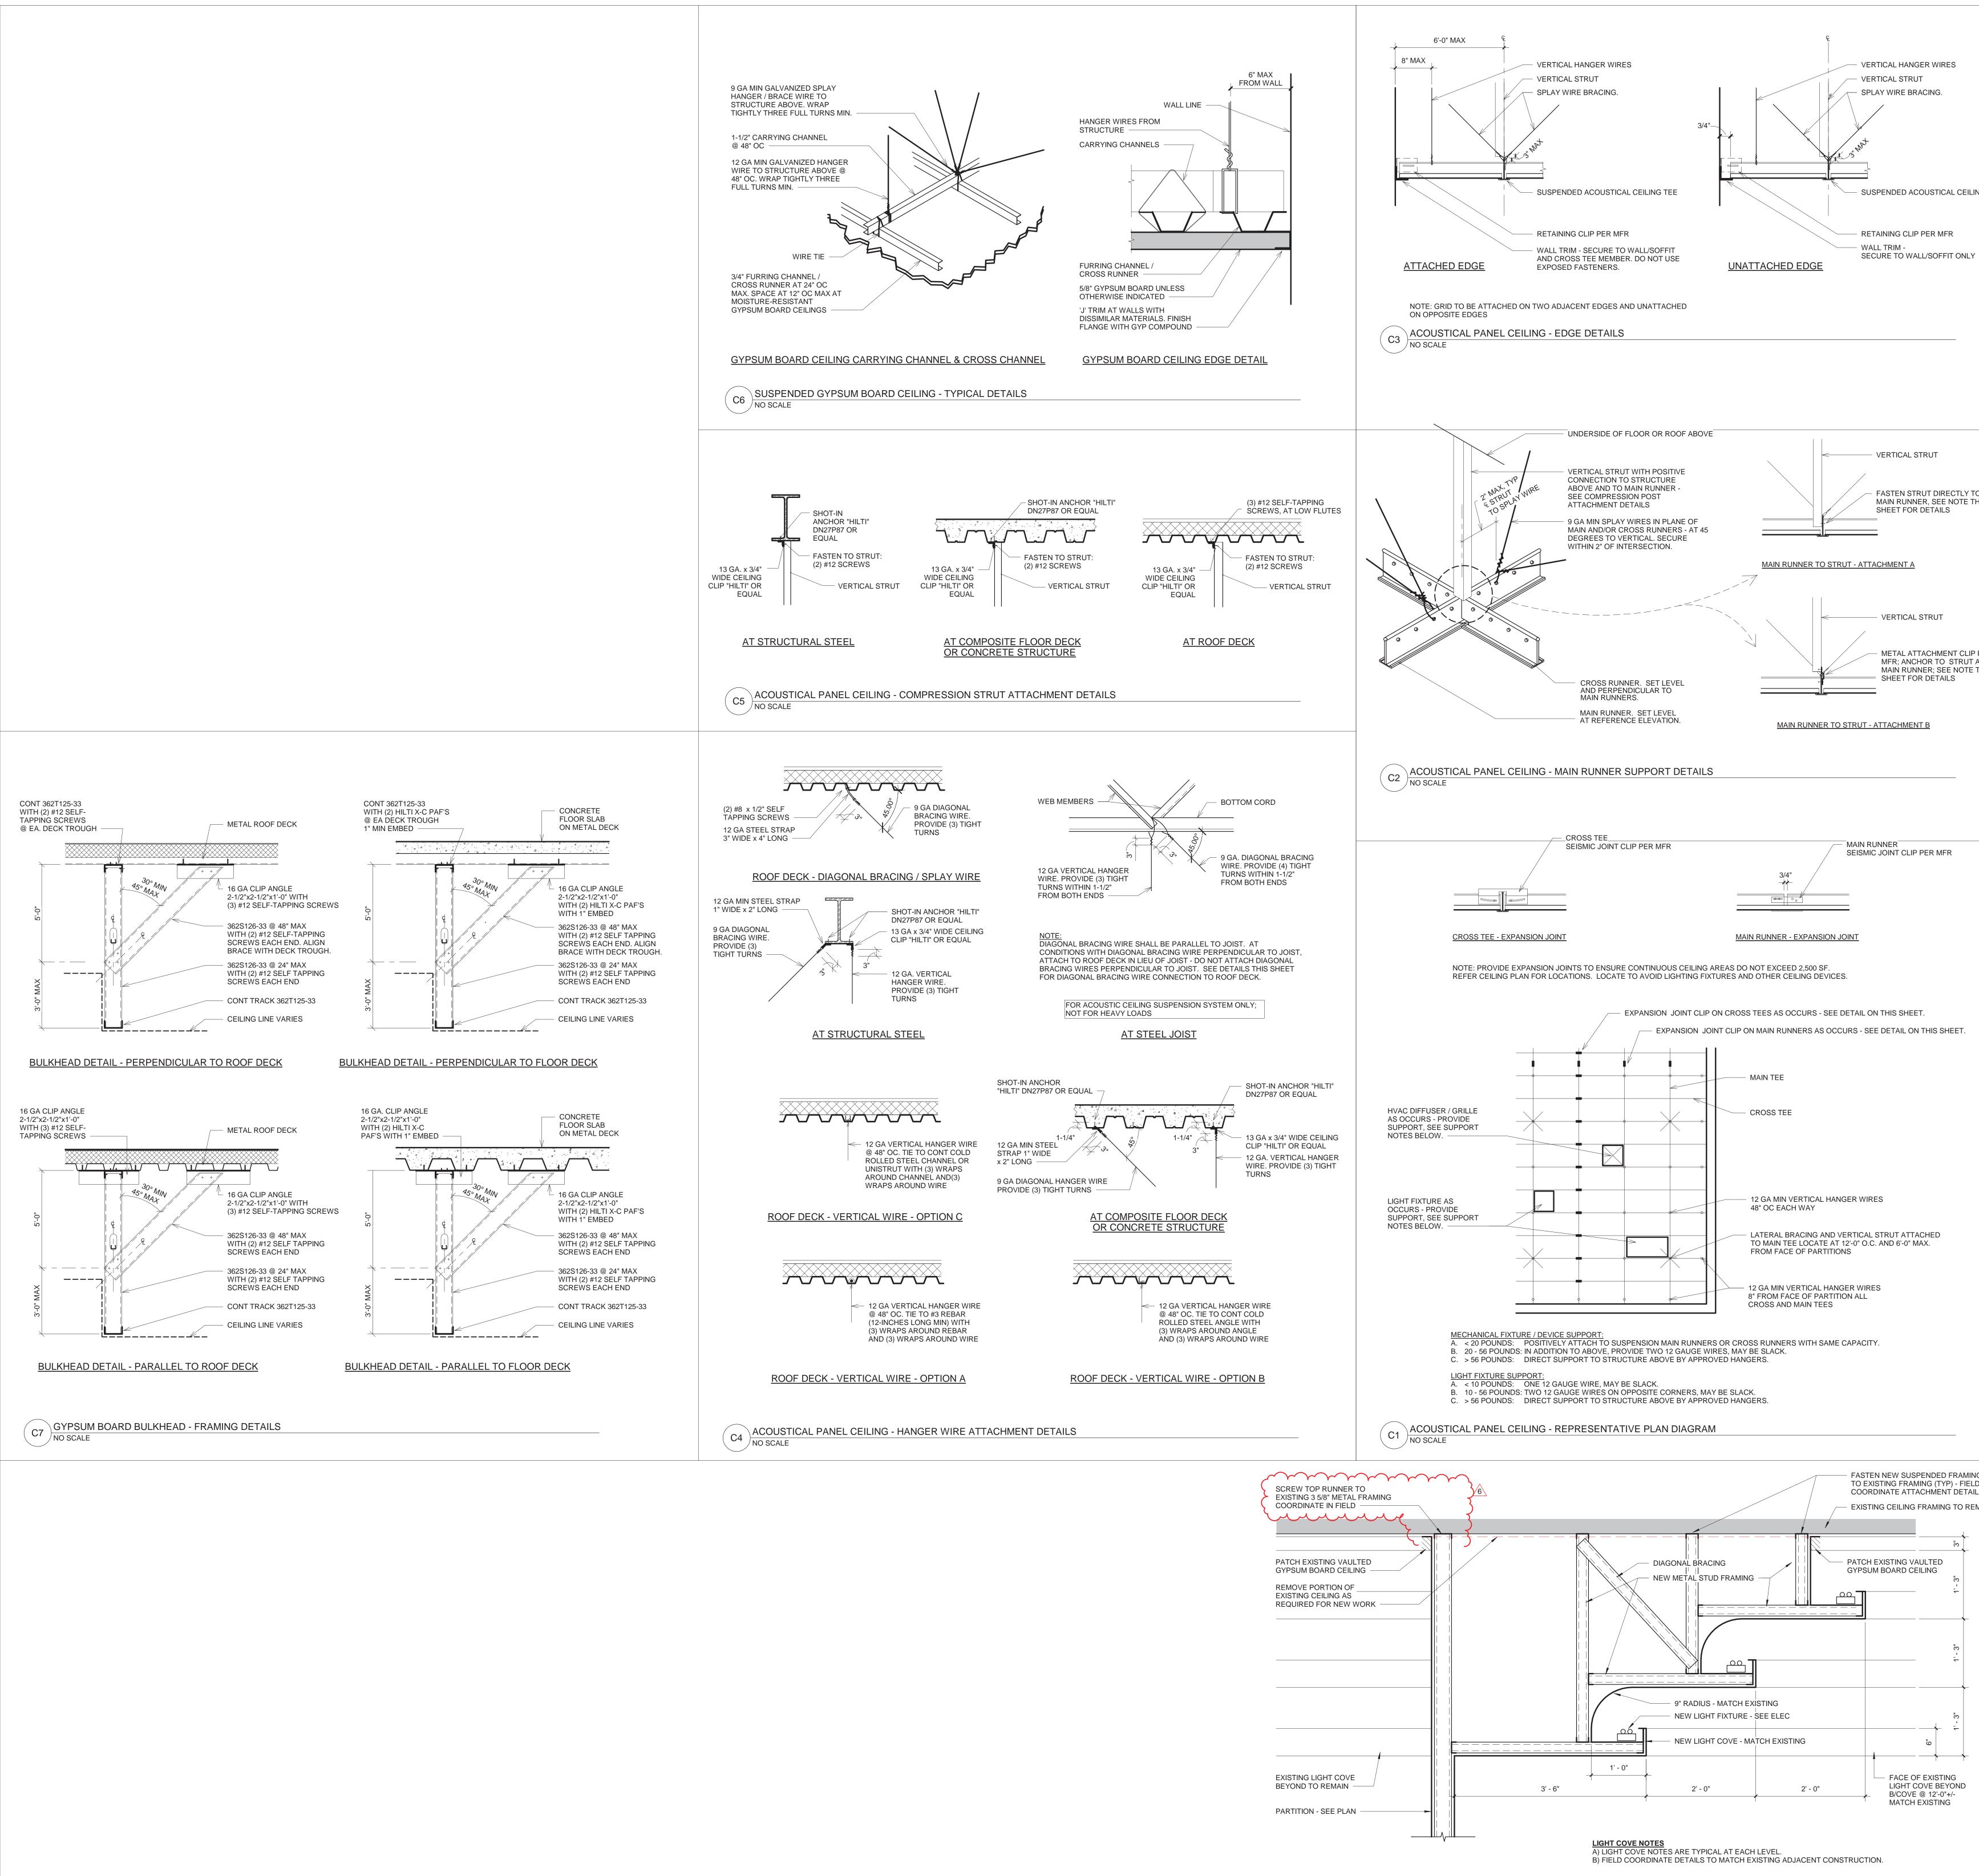


SECTION - CEILING COVE @ DEMISING WALL / 1" = 1'-0"


GENERAL NOTES - CEILINGS	
<u>GENERAL NOTES - ALL CEILING ASSEMBLIES</u> A. REFER TO CEILINGS AND INTERIOR SYSTEMS CONSTRUCTION ASSOCIATION (CISCA) "GUIDELINES FOR SEISMIC RESTRAINT FOR DIRECT HUNG SUSPENDED	
CEILING ASSEMBLIES - SEISMIC ZONES 3-4". <u>ACOUSTIC PANEL CEILINGS - GENERAL NOTES</u> A. REFER TO RESPRESENTATIVE PLAN DIAGRAM ON THIS SHEET FOR TYPICAL ACOUSTICAL PANEL CEILING CONDITIONS AND REQUIREMENTS. REFER TO INTERIOR DOCUMENTS FOR GRID SPACING, LAYOUT, TYPE, SIZE, ORIENTATION AND LOCATIONS.	macysinc
<ol> <li>CONTRACTOR MUST PROVIDE SPECIFIED SUSPENSION SYSTEMS TO MEET STANDARDS AND REQUIREMENTS INDICATED IN THE CONTRACT DOCUMENTS. NO SUBSTITUTIONS PERMITTED UNLESS APPROVED IN WRITING BY STRUCTURAL ENGINEER OF RECORD OR ARCHITECT.</li> <li>PARTITIONS THAT ARE TIED TO THE CEILING AND ALL PARTITIONS GREATER THAN 6 FEET IN HEIGHT SHALL BE LATERALLY BRACED TO THE STRUCTURE. BRACING SHALL BE INDEPENDENT OF THE CEILING SPLAY BRACING SYSTEM.</li> </ol>	
ALL MAIN BEAMS ARE TO BE "HEAVY DUTY ACOUSTICAL CEILING SUSPENSION SYSTEM GRID" AND ALL CROSS TEES TO BE "HEAVY DUTY ACOUSTICAL SUSPENSION SYSTEM CROSS TEE". ALL WIRE TIES ARE TO BE THREE TIGHT TURNS AROUND ITSELF WITHIN THREE INCHES, 12-GAUGE HANGER WIRE SPACED 4 FEET ON CENTER. CHANGES IN CEILING PLANES REQUIRE POSITIVE BRACING.	STORE ENVIRONMENT Store Planning • Architecture Construction • Engineering
DUSTIC PANEL CEILING NOTES - LATERAL BRACING LATERAL FORCE BRACING SHALL BE 12 FEET ON CENTER (MAXIMUM) AND BEGIN NO FARTHER THAN 6 FEET FROM WALLS. SEISMIC SPLAY WIRES SHALL BE FOUR 9-GAUGE WIRES ATTACHED TO THE MAIN BEAM. WIRES ARE ARRAYED 90 DEGREES FROM EACH OTHER AND AT AN ANGLE NOT EXCEEDING 45 DEGREES FROM THE PLANE OF THE CEILING. POWDER-ACTUATED FASTENERS SHALL HAVE AN ICC-ES APPROVAL FOR SEISMIC APPLICATIONS. SPLAY WIRES SHALL BE FASTENED WITHIN 2 INCHES OF THE CONNECTION OF	145 Progress Place Springdale, OH 45246
THE VERTICAL STRUE TO SUSPENDED CEILING. RIGID BRACING MAY BE USED IN LIEU OF SPLAY WIRES. VERTICAL STRUTS MUST BE POSITIVELY ATTACHED TO THE SUSPENSION SYSTEMS AND THE STRUCTURE ABOVE. <u>OUSTIC PANEL CEILING NOTES - WALL TRIM (MOLDING)</u> THE GRID SHALL BE ATTACHED AT TWO ADJACENT WALLS (POP RIVETS OR	ACHA ANDREW C. HARTE ARCHITECT
APPROVED METHOD). A SOFFIT MAY BE DEEMED EQUIVALENT TO WALLS IF IT EXTENDS TO A POINT AT LEAST LEVEL WITH THE BOTTOM PLANE OF THE GRID AND IS INDEPENDENTLY SUPPORTED AND LATERALLY BRACED TO THE STRUCTURE ABOVE.	16 East 12th Street, Cincinnati OH 45202 (513) 549-6879 architecture359.com
TERMINAL ENDS OF MAIN RUNNERS AND CROSS MEMBERS SHALL BE TIED TOGETHER OR HAVE SOME OTHER APPROVED MEANS TO PREVENT THEIR SPREADING. STABILIZER BARS, CROSS TEES OR OTHER MEANS TO PREVENT SPREADING SHALL OCCUR WITHIN 8 INCHES OF EACH WALL. SPREADER BARS ARE NOT REQUIRED AT PERIMETERS WHERE RUNNERS ARE ATTACHED DIRECTLY TO CLOSURE ANGLES. SPREADER BARS ARE NOT REQUIRED IF A 90 DEGREE INTERSECTING CROSS OR MAIN IS WITHIN 8 INCHES OF THE PERIMETER WALL.	PROFESSIONAL SEAL
DUSTIC PANEL CEILING NOTES - HANGER (SUSPENSION) WIRES HANGER AND PERIMETER WIRES MUST BE PLUMB WITHIN 1 AND 6 UNLESS (FIGURE 5A) COUNTER SLOPING WIRES ARE PROVIDED. HANGER WIRES SHALL BE 12 GAUGE AND SPACED 4-FEET ON CENTER OR 10 GAUGE AND SPACED 5-FEET ON CENTER. TERMINAL ENDS OF EACH MAIN BEAM AND CROSS TEE MUST BE SUPPORTED WITHIN 8-INCHES OF EACH WALL WITH A PERIMETER WIRE. WIRES SHALL NO ATTACH TO OR BEND AROUND INTERFERING MATERIAL OR EQUIPMENT.	ANDREW HARTE STATE OF WASHINGTON
<ul> <li><u>YPSUM BOARD CEILINGS - GENERAL NOTES</u></li> <li>SPACE 9-GAUGE MINIMUM WIRES AT 48 INCHES ON CENTER ALONG CARRYING CHANNEL AND WITHIN 6 INCHES OF THE END OF CARRYING CHANNNEL RUNS.</li> <li>INSTALL 1-1/2 INCH CARRYING CHANNELS AT 48 INCHES ON CENTER AND WITHIN 6 INCHES FROM WALL. PROVIDE 1 INCH CLEARANCE BETWEEN RUNNERS AND ABUTTING WALLS AND PARTITIONS. AT SPLICES, OVERLAP ENDS</li> </ul>	
12 INCHES AND SECURE EACH END WITH THE WIRE. ERECT METAL FRAMING AT RIGHT ANGLE TO CARRYING CHANNELS. SPACE STUDS WITHIN 6 INCHES OF WALL. PROVIDE 1 INCH CLEARANCE BETWEEN RUNNER ENDS ABUTTING WALLS AND PARTITIONS. ATTACH STUDS TO 1-1/2 INCH CARRYING CHANNELS WITH 12-GAUGE MINIMUM TIE WIRE. SPACE MEMBERS AT 16 INCHES ON CENTER AT SPLICE, NEST STUDS WITH AT LEAST 8 INCHES OVERLAP AND SECURELY WIRE TIE EACH END WITH FOUR DOUBLE STRANDS OF TIE WIRES.	
<ul> <li>BRACE TO STRUCTURE ABOVE AS SPECIFIED. USE 9-GAUGE MINIMUM DIAGONAL WIRES SPACED ON HANGING POINTS OF GRID AND WITHIN 6 FEET OF WALLS. SPACE DIAGONAL BRACING AS REQUIRED.</li> <li>ANCHOR DRYWALL TO SUPPORTING HORIZONTAL STUDS WITH #8x1 MINIMUM SELF-TAPPING DRYWALL SCREWS AT 12 INCHES ON CENTER IN THE FIELD OF GYPSUM BOARD AND AT 8 INCHES ON CENTER AT BUTT JOINTS. LOCATE NO LESS THAN 3/8 INCH OR MORE THAN 1/2 INCH FROM EDGE OF BOARD.</li> <li>REFER TO ELECTRICAL DOCUMENTS FOR INDEPENDENT SUSPENSION</li> </ul>	
REQUIREMENTS FOR LIGHT FIXTURES IN SUSPENDED GYPSUM BOARD CEILING CONSTRUCTION.	
<ul> <li>APABLE OF WITHSTANDING NOT LESS THAN 180 LBF (445 N) OR DESIGN LOAD, /HICHEVER IS GREATER, BUT NOT LESS THAN THE FOLLOWING:</li> <li>SLOTTED CHANNEL FRAMING: BASIS OF DESIGN: UNISTRUT. REFER TO DIVISION 5 SECTION "METAL FABRICATIONS - SEISMIC" AND DIVISION 9 SECTION "ACOUSTICAL PANEL CEILINGS - SEISMIC" FOR ADDITIONAL DETAIL.</li> <li>A. 13/16-INCHES BY 13/16-INCHES (21mm BY 21mm), FOR COMPRESSION STRUTS UP TO 48 INCHES (1828mm) IN HEIGHT.</li> <li>B. 1-1/4-INCHES BY 1-1/4-INCHES (32mm BY 32mm), FOR COMPRESSION</li> </ul>	
<ul> <li>STRUTS UP TO 72 INCHES (1828mm) IN HEIGHT.</li> <li>C. 1-5/8-INCHES BY 1-5/8-INCHES (41mm BY 41mm), FOR COMPRESSION STRUTS UP TO 144 INCHES (3657mm) IN HEIGHT.</li> <li>D. 1-5/8-INCHES BY 3-1/4-INCHES (41mm BY 83mm), FOR COMPRESSION STRUTS UP TO 192 INCHES (4876mm) IN HEIGHT.</li> <li>NON-STRUCTURAL METAL FRAMING:</li> <li>A. 2-1/2-INCHES (63.5mm), WITH FLANGES NOT LESS THAN 1-1/4-INCHES (31.75mm), FOR COMPRESSION STRUTS UP TO 84 INCHES (2133mm) IN HEIGHT.</li> <li>a. MINIMUM DESIGN BASE-METAL THICKNESS: NOT LESS THAN 0.031-INCH</li> </ul>	
<ul> <li>(0.80mm) (20 GAUGE) THICKNESS DESIGNATOR 30, UNLESS OTHERWISE REQUIRED BY CONDITIONS.</li> <li>B. 2-1/2-INCHES (63.5mm), WITH FLANGES NOT LESS THAN 1-5/8-INCHES (41.27mm), FOR COMPRESSION STRUTS UP TO 120 INCHES (3048mm) IN HEIGHT.</li> <li>a. MINIMUM DESIGN BASE-METAL THICKNESS: NOT LESS THAN 0.031-INCH (0.80mm) (20 GAUGE) THICKNESS DESIGNATOR 30, UNLESS OTHERWISE REQUIRED BY CONDITIONS.</li> <li>C. 3-5/8-INCHES (92mm), WITH FLANGES NOT LESS THAN 1-5/8-INCHES (41.27mm), FOR COMPRESSION STRUTS UP TO 120 INCHES (3048mm) IN HEIGHT.</li> <li>a. MINIMUM DESIGN BASE-METAL THICKNESS: NOT LESS THAN 0.031-INCH (0.80mm) (20 GAUGE) THICKNESS DESIGNATOR 30, UNLESS OTHERWISE</li> </ul>	
REQUIRED BY CONDITIONS. /ERTICAL STRUT FASTENING TO CEILING SUSPENSION SYSTEM MAIN RUNNER: I. FASTEN METAL FRAMED COMPRESSION STRUT TO MAIN BEAMS BY ONE OF THE FOLLOWING: A. ATTACH AND ANCHOR FRAMING COMPRESSION STRUT WEB DIRECTLY BELOW TOP BULB OF CEILING SUSPENSION MAIN BEAM WITH NOT LESS THAN 2 SHARP POINT PAN-HEAD LOW-PROFILE #10 SCREW FASTENERS.	
<ul> <li>B. ATTACH AND ANCHOR METAL ATTACHMENT CLIP TO METAL FRAMED COMPRESSION STRUT THROUGH WEB OF FRAMING WITH NOT LESS THAN 2 SHARP POINT PAN-HEAD LOW-PROFILE #10 SCREW FASTENERS. ATTACH AND ANCHOR CLIP TO SIDE OF MAIN BEAM FLANGE BELOW TOP BULB OF MAIN RUNNER WITH NOT LESS THAN 2 SHARP POINT PAN-HEAD LOW-PROFILE #10 SCREW FASTENERS.</li> <li>DRIVE SCREW FASTENERS TO EXTEND THROUGH SHEET STEEL AND MAIN BEAM CONNECTION A MINIMUM OF 3 EXPOSED THREADS, TO PENETRATE INDIVIDUAL COMPONENTS WITHOUT CAUSING PERMANENT SEPARATION BETWEEN COMPONENTS.</li> </ul>	
City of Puyallup	
Development & Permitting Services ISSUED PERMIT Building Planning	
Engineering     Public Works       Fire     Traffic	6     BULLETIN 3     8/22/2022       2     ISSUED FOR PERMIT     5/6/2022       NO.     REVISIONS     DATE
	MACY'S SOUTH HILL MALL 3500 SOUTH MERIDIAN, SUITE 985 PUYALLUP, WA 98373
	PROJECT INTERIOR ALTERATIONS ARCHITECT'S 202100475 PROJECT NO.
	SHEET TITLE
	CEILING DETAILS
PRCTI20220811	SHEET NO. A502

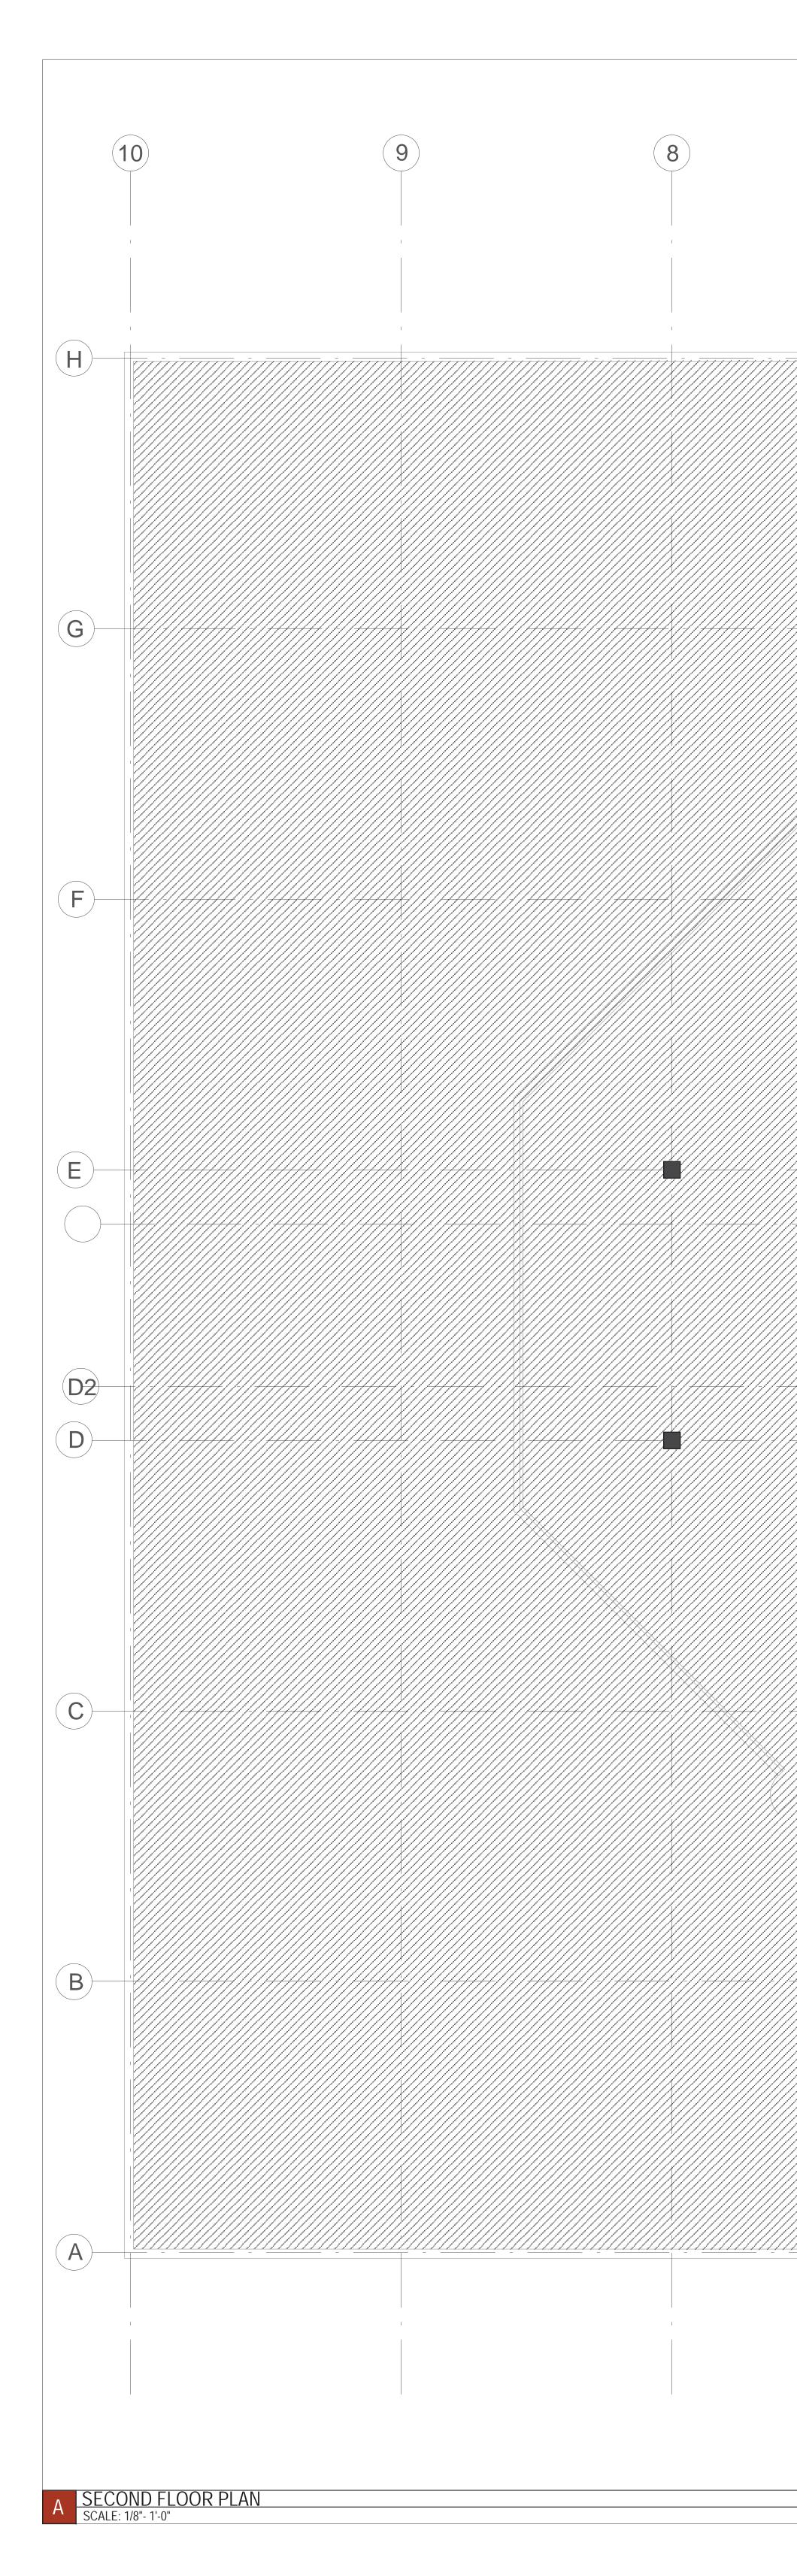

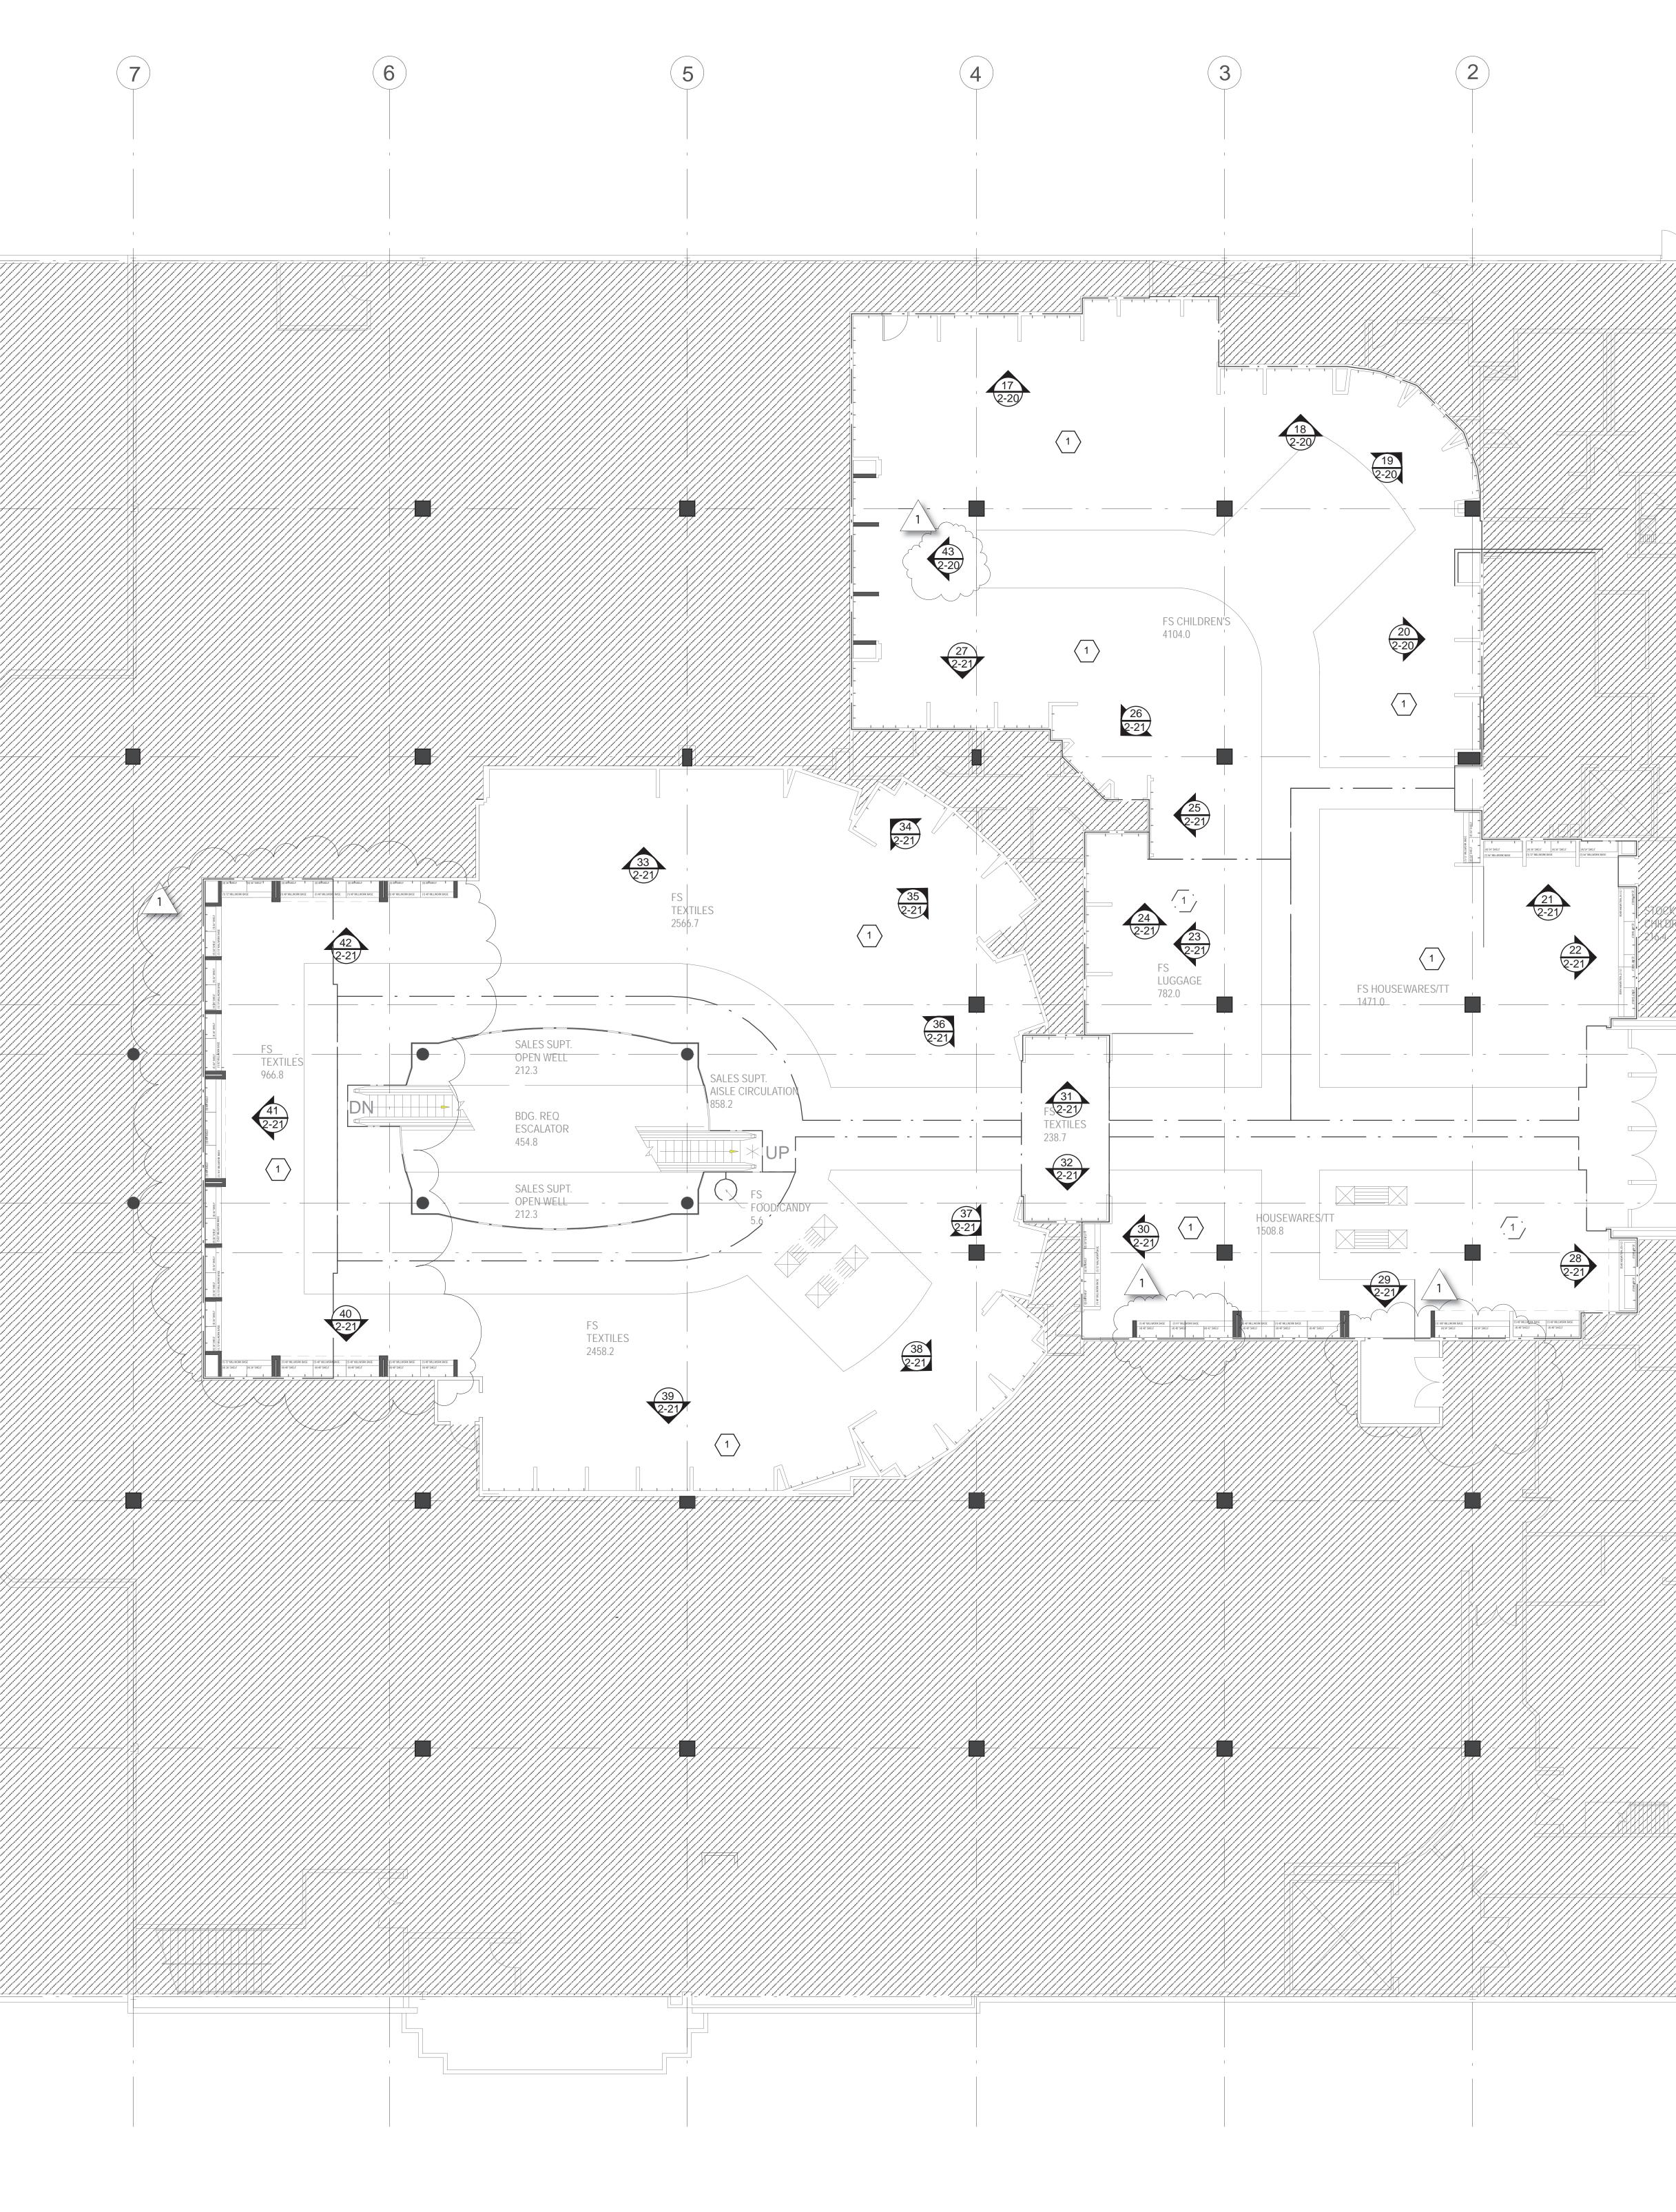



PRC1	<b>[12022081</b> ]

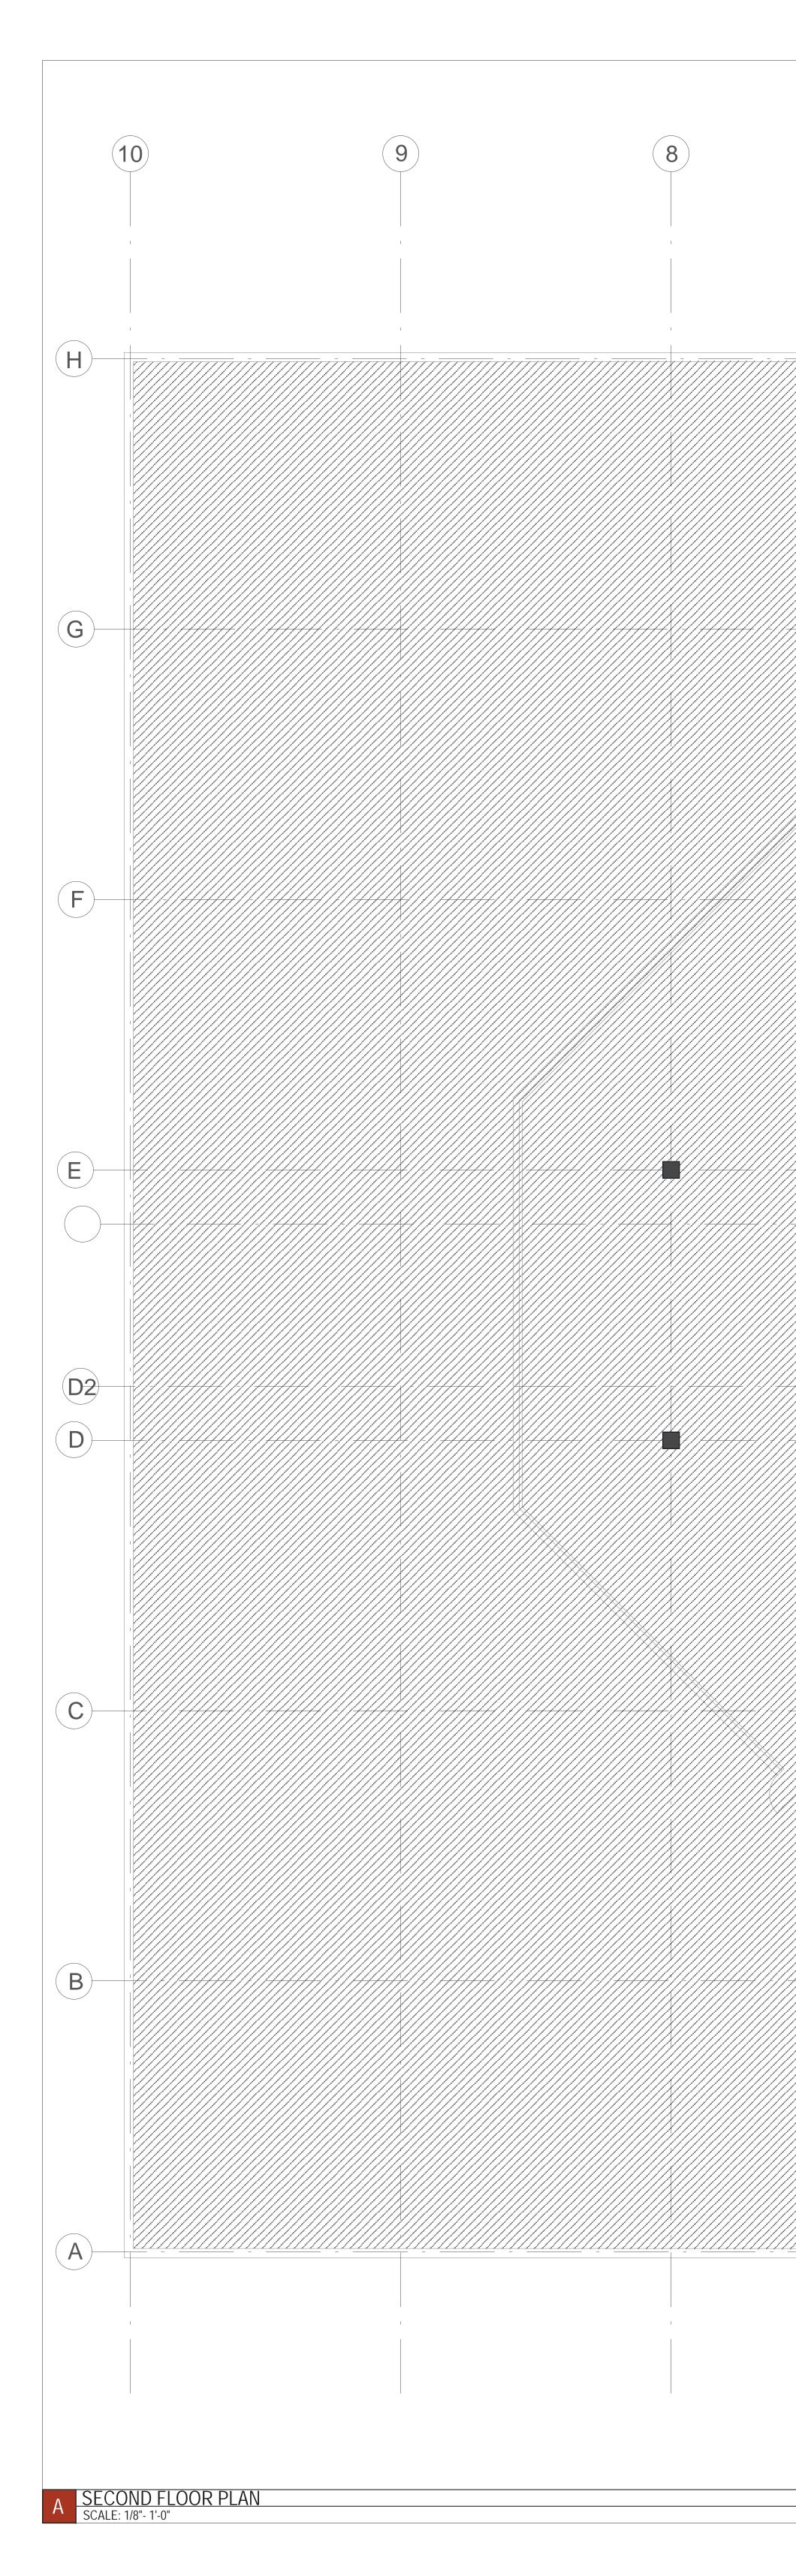

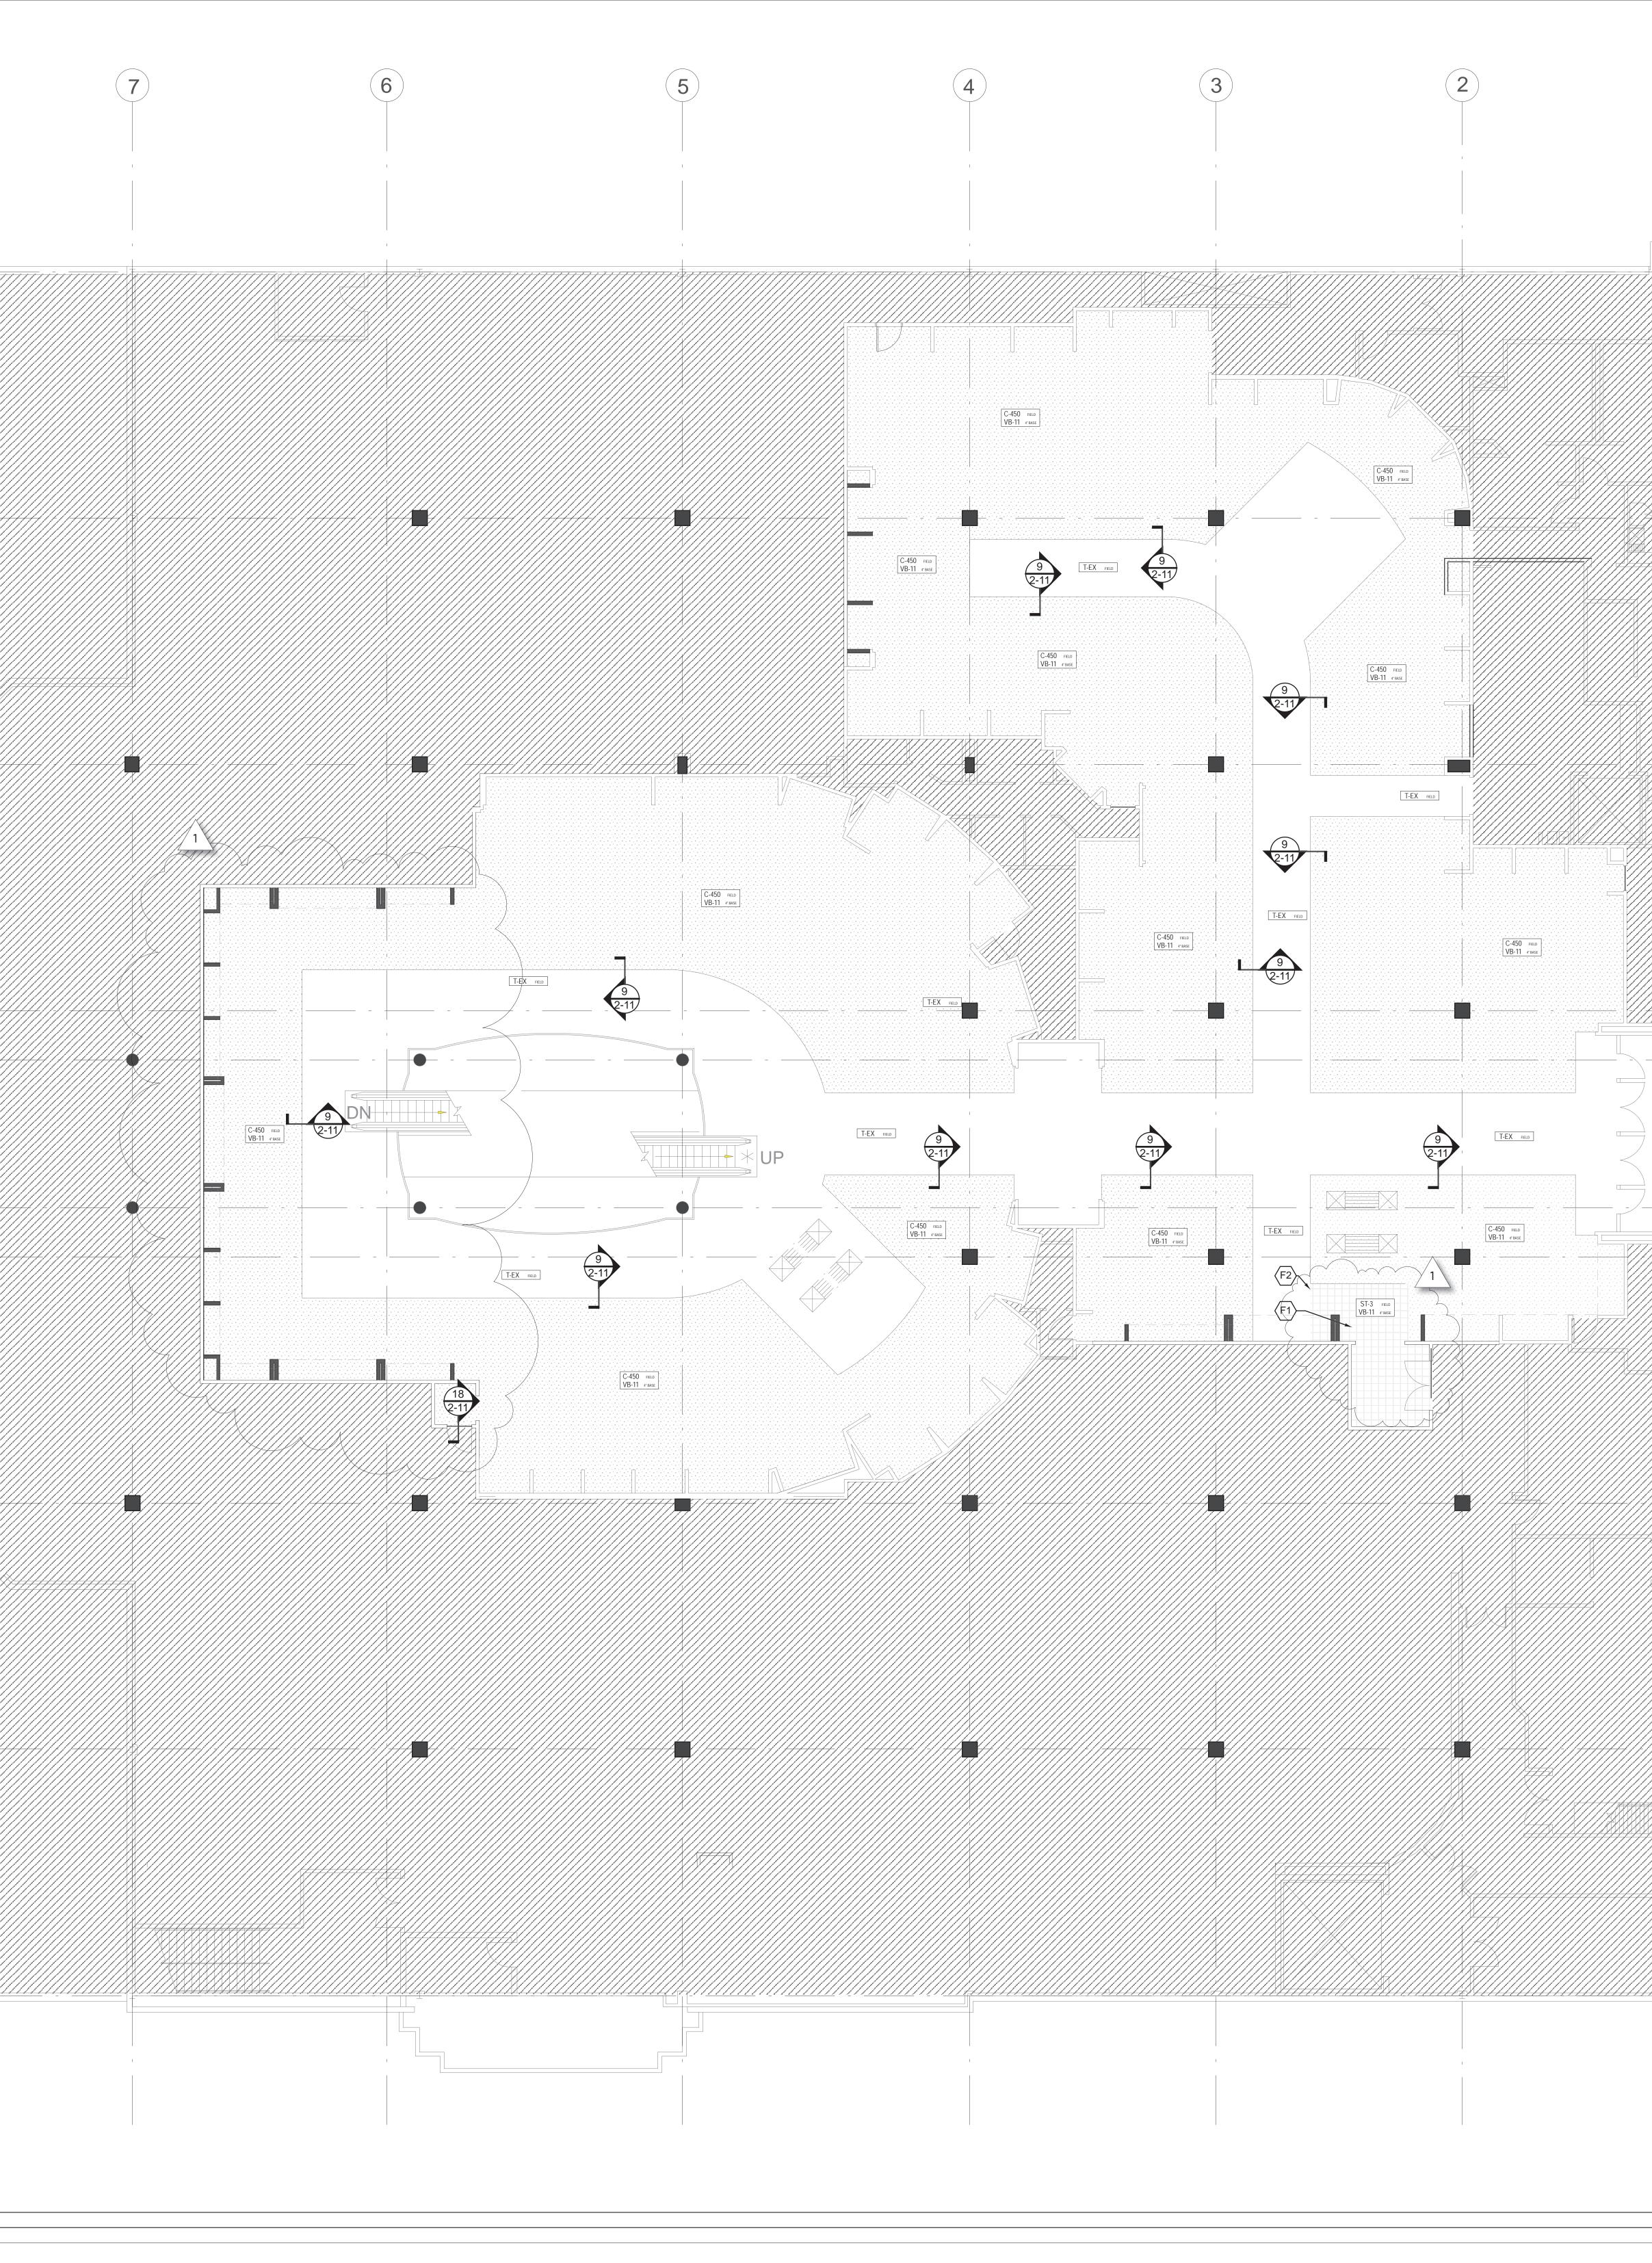


FLOORCOVERING NOTES DRAWING NOTES	*
$ \begin{array}{ c c c } \hline F1 & \text{NEW TILE TO ALIGN WITH EXISTING TILE} \\ \hline \text{AND GROUT.} \\ \hline \hline F2 & \text{INDICATES FULL TILE FOR START OF} \\ \hline \text{PATTERN.} \\ \end{array} $	macysinc
INDICATES AREA TO RECEIVE T-TBD         INDICATES AREA TO RECEIVE C-450         AND VB-11         AREA NOT IN SCOPE	STORE ENVIRONMENT Store Planning • Architecture Construction • Engineering 145 Progress Place Springdale, OH 45246
PLAN SYMBOLS FLOOR COVERING IDENTIFIER: REFER TO C&M SPECIFICATION BOOK(s).	ACHA
C-800       FIELD       FIELD MATERIAL         C-816       BORDER       BORDER WHERE OCCURING         C-401       PAD       PAD UNDERLAYMENT WHERE OCCURING         WD-703       BASE       BASE MATERIAL         ID PREFIX TYPES:       ID PREFIX TYPES:	ANDREW C. HARTE ARCHITECT 16 East 12th Street, Cincinnati OH 45202 (513) 549-6879 architecture359.com
C     CARPET TYPE       T     TILE TYPE       VT     VINYL FLOORING	22002520 REGISTERED ARCHITECT ANDREW HARTE STATE OF WASHINGTON
VCT     VINYL COMPOSITE FLOORING       EX     EXISTING FLOORING	
<ol> <li>FLOOR COVERING PLAN NOTES:</li> <li>REFER TO COLOR &amp; FINISH BOOK FOR FLOOR COVERING FINISH CODES AND SPECIFICATIONS.</li> <li>ALL TILE IS PARALLEL AND PERPENDICULAR TO THE PERIMETER OF THE BUILDING UNLESS NOTED OTHERWISE.</li> </ol>	
<ol> <li>ALL ANGLES ARE 45°, 90° AND 135° DEGREES UNLESS NOTED OTHERWISE.</li> <li>ALL STOCK ROOM ENTRIES LOCATED DIRECTLY OFF CARPETED SALES AREAS MUST RECEIVE A WALK-OFF - REFER TO 16/0-8.</li> <li>TILE IS SHOWN FOR FIELD RUN AND PATTERN ONLY. REFER TO COLOR AND FINISH BOOK FOR MATERIAL SPECIFICATIONS.</li> </ol>	
<ul> <li>6. AISLE DIMENSIONS ARE ACTUAL. REFER TO PLAN DETAILS AND SPECIFICATIONS FOR FURTHER INFORMATION.</li> <li>7. ALL BACK AREAS SUCH AS, BUT NOT LIMITED TO, STOCKROOMS, STORAGE AREAS AND MECHANICAL ROOMS SHALL NOT RECEIVE FLOOR COVERING UNLESS NOTED OTHERWISE. CONCRETE SEALER TO BE APPROVED BY MACY'S INC.</li> </ul>	
<ol> <li>8. REFER TO LOOSE FIXTURE BOOK AND PERIMETER WALL BOOK FOR ALL FLOOR FIXTURES AND PERIMETER FIXTURES WHICH REQUIRE FLOORCOVERING.</li> <li>9. REFER TO SHEET 2-11 FOR TYPICAL FLOOR DETAILS.</li> </ol> GENERAL NOTES:	
<ol> <li>ALL SLAB CONDITIONS SUCH AS CRACKS, HOLES, MINOR DEVIATIONS, ETC. TO BE EVALUATED BY FLOORING CONTRACTOR PRIOR TO COMMENCEMENT OF WORK. ANY DISCREPANCIES OR SITUATIONS PROHIBITING INSTALLATION OF SPECIFIED FLOORING MATERIAL TO BE BROUGHT TO OWNER'S ATTENTION.</li> <li>PRIOR TO INSTALLING SPECIFIED NEW FLOORING MATERIAL ON CONCRETE SLAB, ALL SLAB DEVIATIONS MUST BE REPAIRED, SUCH THAT THE SURFACE IS SMOOTH, CLEAN AND FREE OF ALL</li> </ol>	
DEBRIS THAT MAY AFFECT ADHESION AND LONGEVITY OF APPLICATION MATERIAL. WHEN USING CONCRETE SLAB AS THE FINISHED FLOOR, REFER TO SPECIAL FLOORING NOTES IN THE COLOR AND MATERIAL SPECIFICATION BOOK. 3. WHERE FINISHED CONCRETE FLOORING IS TO BE THE EXPOSED FLOOR SURFACE AT THE SALES FLOOR, CONCRETE SLAB DEVIATIONS ARE TO BE REPAIRED SUCH THAT THE SURFACE IS SMOOTH, CLEAN, AND FREE OF DEBRIS. MINOR COLOR VARIATIONS ARE ACCEPTABLE.	
<ul> <li>4. FLOORING INSTALLER IS RESPONSIBLE FOR TESTING SLAB CONDITION FOR MOISTURE, GENERAL ALKALI CONTENT, ETC. AS REQUIRED FOR OPTIMAL PERFORMANCE OF SPECIFIED FLOORING MATERIAL.</li> <li>5. SURFACE ALIGNMENT BETWEEN VARYING MATERIALS SHALL BE ADDRESSED AS INDICATED ON SPECIFIC FLOORING DETAILS.</li> <li>6. ALL CROSS-AISLE INTERSECTIONS TO RECEIVE FULL TILES OR TRUE (CORNER-TO-CORNER) DIAGONAL CUT TILES. DUTCHMEN</li> </ul>	
<ul> <li>WHEN REQUIRED TO BE LIMITED TO CONTINUOUS AISLE RUNS AND WILL BE CUT DOWN NO MORE THAN 2" PER FULL TILE OVER A SERIES OF ROWS AS REQUIRED TO ACHIEVE DESIRED ALIGNMENT AT AISLE INTERSECTIONS.</li> <li>7. FLOORING CONTRACTOR IS RESPONSIBLE FOR LAYING OUT MATERIAL SUCH THAT A MINIMUM QUANTITY OF DYE LOT VARIATION OCCURS.</li> <li>8. FLOORING CONTRACTOR TO SUBMIT CARPET SEAMING DIAGRAMS TO OWNER'S REPRESENTATIVE (ID CONSULTANT)</li> </ul>	
FOR APPROVAL. 9. FLOORING CONTRACTOR IS EXPECTED TO PROTECT NEW FLOORING INSTALLATION WITH REINFORCED PAPER AND PATH BOARDS AFTER REVIEW AND ACCEPTANCE OF WORK BY OWNER OR OWNER'S REPRESENTATIVE UNTIL CONSTRUCTION IS COMPLETE IN AREA. PLASTIC OR PRODUCTS WITH SELF ADHESIVE ARE NOT BE USED FOR FLOORING PROTECTION. 10. ALL FLOORING IS TO BE INSTALLED PER INDUSTRY STANDARDS. (EX: CRI #104 FOR CARPET)	
12. ALL EXISTING BASE MILLWORK IN TEXTILES DEPARTMENT TO BE PAINTED PT-1 WITH BONDING PRIMER, INTERMEDIATE AND TOP COAT. SEE FINISH SPECIFICATIONS FOR DETAL.	1       BULLETIN 1       07/19/22         A       TI BID & PERMIT       05/5/22         NO.       REVISIONS       DATE         ★
	PUYALLUP SOUTH HILL (WA) 3500 SOUTH MERIDIAN PUYALLUP, WA 98373
 City of Puyallup	PROJECT NO. XXXXXXX DATE DRAWN BY CHECKED BY SCALE
City of Puyallup         Development & Permitting Services         ISSUED PERMIT         Building       Planning         Engineering       Public Works         Fire       Traffic	SHEET TITLE SECOND FLOOR FLOORCOVERING & FINISH PLAN
	SHEET NO. <b>2-8</b>
CTI20220044	

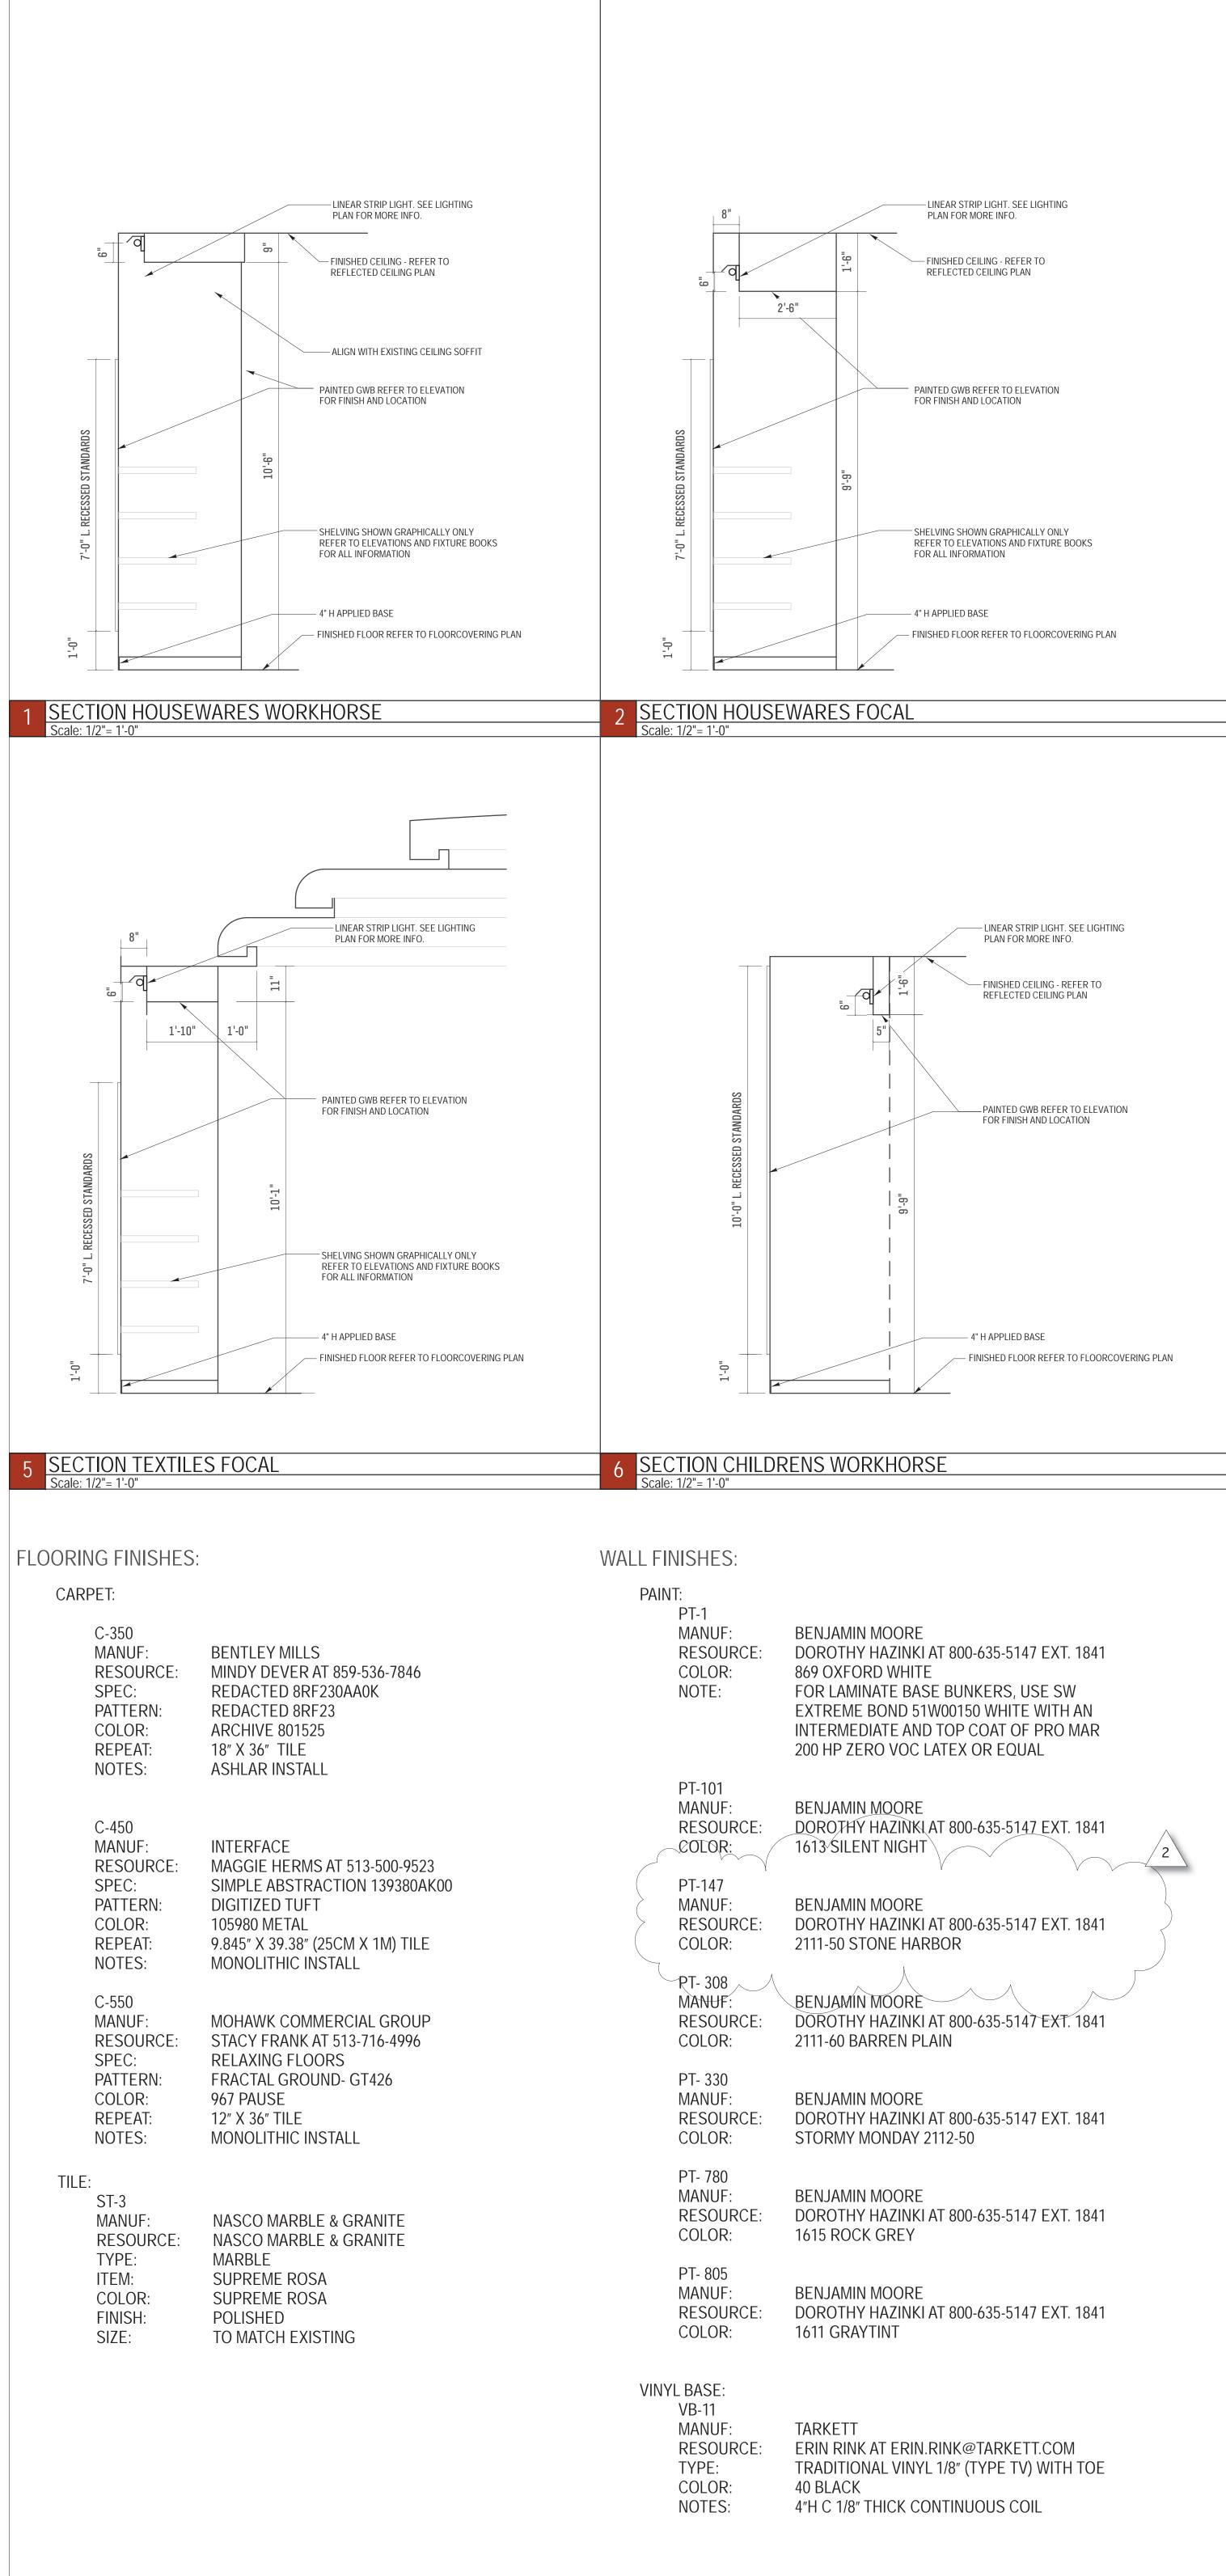

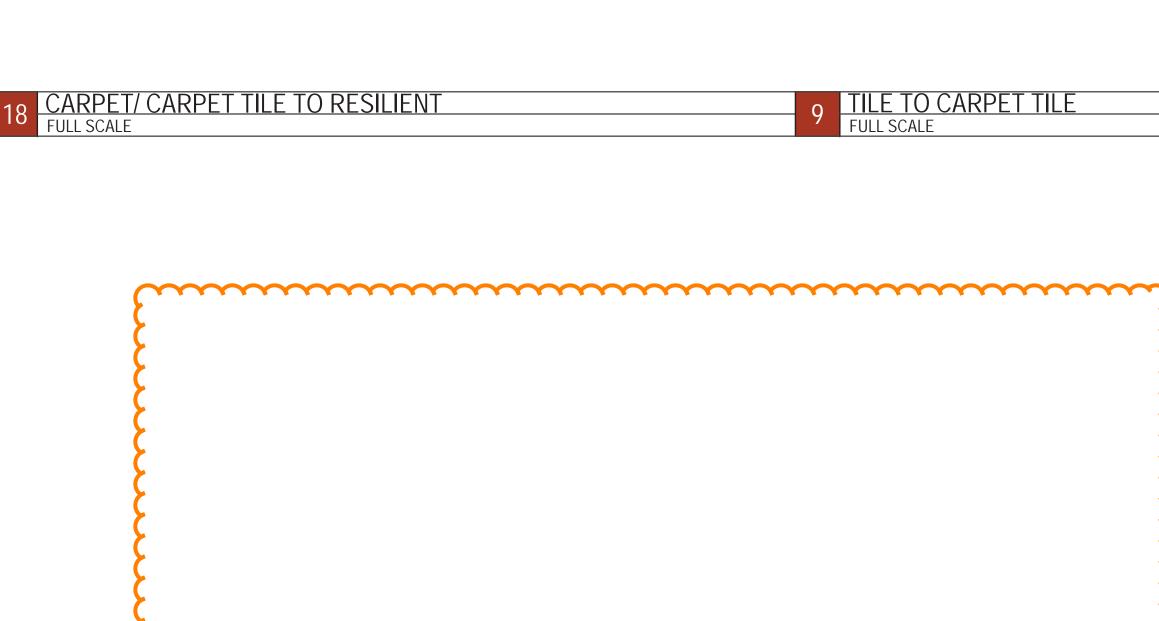

JOHNSONITE RUBBER REDUCER @C-350 USE CTA 20 CHARCOAL @C-450 USE CTA 20 CHARCOAL CARPET/ - VCT/VINYL CARPET TILE 1 1/4" 

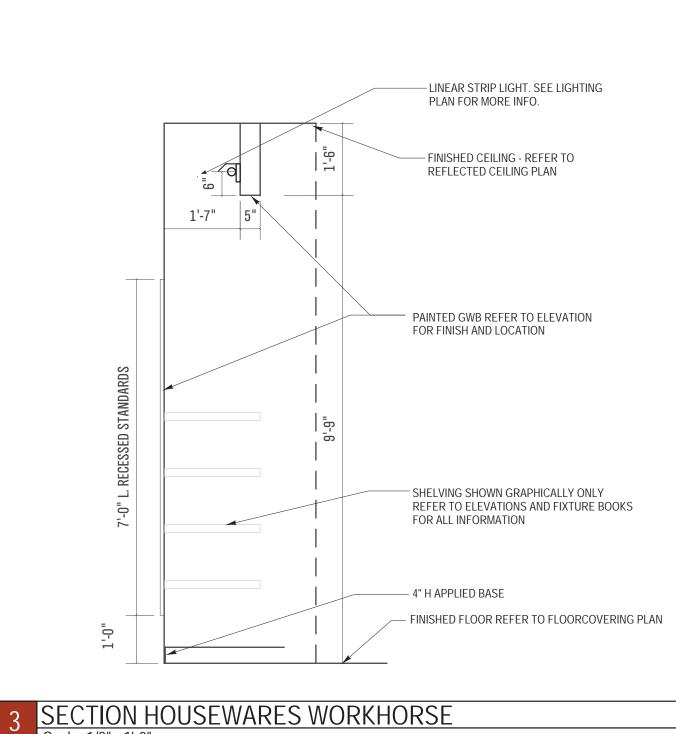



## GENERAL FINISH NOTES

A. ALL SUBMITTALS AND QUESTIONS REGARDING FINISH SPECIFICATIONS SHALL BE DIRECTED TO THE

B. CONTRACTORS ARE RESPONSIBLE FOR NOTIFYING SPECIFIED RESOURCES THAT THEY ARE PURCHASING FOR A MACY'S PROJECT TO RECEIVE ANY PRICING OR LEAD TIMES NOTED WITHIN

1. THE FINISHES INDICATED ON THE FIXTURE FINISH SCHEDULE OR AREA PLAN SHALL SUPERSEDE ANY FINISHES ON FIXTURE DETAIL DRAWINGS. ALL CONTRACTORS SUPPLYING NATURAL FINISH WOODWORK AND COLOR LACQUER SHALL PROVIDE 10" X 9" SAMPLES OF EACH FINISH TO THE ARCHITECT FOR APPROVAL ALL PLUG MOLDINGS IN FIXTURE WORK SHALL BE RECESSED AND PAINTED TO MATCH THE ADJACENT SURFACE.

ALL INSIDE VALANCE RETURNS SHALL BE FINISHED TO MATCH THE EXTERIOR FACE OF THE VALANCE UNLESS NOTED OTHERWISE 5. ALL EXPOSED ENDS AND UNDERSIDES OF SHELVES SHALL BE FINISHED TO MATCH THE FRONT EDGE AND TOP UNLESS NOTED OTHERWISE. ALL BUNKER ENDS SHALL BE FINISHED TO MATCH THE FRONT FACE OF THE BUNKER UNLESS NOTED OTHERWISE. FINISHES THAT ARE INDICATED ON ELEVATIONS SHALL SUPERSEDE ALL FINISHES NOTED ON SECTIONS AND/OR DETAIL DRAWINGS.

1. THE CONTRACTOR IS TO IMMEDIATELY PURCHASE FROM THE RESOURCES SPECIFIED ALL MATERIALS TO AVOID LEAD-TIME PROBLEMS. ANY REQUIRED DEPOSITS ARE THE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR MUST PROVIDE PROOF OF PURCHASE IF REQUESTED BY THE

THE CONTRACTOR IS RESPONSIBLE FOR ANY ADDITIONAL PURCHASE, SHIPPING OR SERVICE CHARGES FROM THEIR DELAY IN ORDERING MATERIALS. THE CONTRACTORS SHOULD NOTE THAT MANY MANUFACTURING FACILITIES CLOSE FOR VACATION DURING JULY OR AUGUST. 6. THE CONTRACTOR IS RESPONSIBLE FOR THE VERIFICATION OF FIREPROOFING

REQUIREMENTS TO MEET LOCAL CODE REGULATIONS. TO ASSURE COLOR CORRECTNESS, THE CONTRACTOR WILL MATCH ALL SAMPLES JNDER THE LIGHTING CONDITIONS OF THE STORE. MACY'S LEGACY STORES ARE COLOR TEMPERATURE 3000 K AND A COLOR RENDERING INDEX OF AT LEAST 80. MAY LEGACY STORES ARE A COLOR TEMPERATURE OF 3500 K. ALL CONTRACTORS ARE RESPONSIBLE FOR PROVIDING CERTIFICATES FOR ALL MATERIAL'S FIRE-RATINGS. CERTIFICATES ARE TO BE GIVEN TO THE MACY'S CONSTRUCTION MANAGER PRIOR TO THE INSTALLATION OF ANY MATERIAL. UPON RECEIPT, ALL MATERIALS ARE TO BE CHECKED BY THE CONTRACTOR TO VERIFY THAT THE CORRECT COLOR, YARDAGE, BACKINGS, FLAME-PROOFING, ETC. HAVE BEEN RECEIVED AND THE MATERIALS ARE NOT DAMAGED.

1.a. NICKEL FINISHES ARE TO BE OBTAINED BY COMBINING ELECTROPLATING AND MECHANICAL FINISHING PROCESSES.

1.b. THE MINIMUM NICKEL THICKNESS ON ALL MILD STEEL PRODUCTS IS TO BE 0.8 MIL ON THE SIGNIFICANT SURFACE, WHICH IS CONSTITUTED BY THE LONGITUDINAL MID-POINT OF THE LONGEST SEGMENT OF POSTS, BRACKETS OR SPINDLES. 1.c. THE NICKEL PLATING MUST BE RESISTANT TO CORROSION AGAINST COMMON COMMERCIAL CLEANERS, ATMOSPHERIC MOISTURE AND HAND OILS. 1.d. THE NICKEL PLATING MUST BE WEAR RESISTANT AGAINST SLIDING HANGERS AND INCIDENTAL ABRASION.

2.a. ANY EXPOSED METAL WORK SPECIFIED TO BE SATIN STAINLESS STEEL IS TO BE FINISHED UNIFORMLY WITH 400 GRIT ABRASIVES. PERFORMANCE IS TO BE THE SAME AS NOTED FOR NICKEL FINISHES ABOVE.

### NOTE TO CONTRACTOR:

1.a. ALL PAINT REQUIRES A SAMPLE SUBMITTAL TO THE ARCHITECT / MACY'S DESIGN FOR APPROVAL PRIOR TO WORK COMMENCING. NO PAINT MAY BE APPLIED PRIOR TO WRITTEN APPROVAL

1.b. SUBSTITUTE PAINT MANUFACTURERS AND SPECIFICATIONS MAY BE CONSIDERED. ALL SUBSTITUTES REQUIRE SAMPLE SUBMITTAL TO THE ARCHITECT / MACY'S DESIGN FOR APPROVAL PRIOR TO WORK COMMENCING. EACH SAMPLE MUST INCLUDE THE PROPOSED SUBSTITUTE SIDE-BY-SIDE WITH THE SPECIFICATION LISTED ON THIS SHEET NO SUBSTITUTES ARE ALLOWED WITHOUT WRITTEN APPROVAL. 1.c. ALL PAINT SAMPLES MUST BE A MINIMUM 4" SQUARE.

ALL PAINT APPLICATIONS SHALL INCLUDE PRIMER TO COVER EXISTING FINISH AND (2) COATS MINIMUM OF INDICATED PAINT. 3. ALL DRYWALL CEILINGS AND ASSOCIATED FACES OF VERTICAL SOFFIT DROPS SHALL BE PAINTED PT-1, FLAT FINISH UNLESS NOTED OTHERWISE. ALL PAINT MATERIALS SHALL BE FIRE-RETARDANT IN ACCORDANCE WITH LOCAL FIRE

DEPARTMENT REGULATIONS. 5. "PT" DESIGNATES PAINT, EGGSHELL FINISH UNLESS NOTED OTHERWISE - SEE ABOVE FOR CEILING AND SOFFIT PAINT FINISH. ALL PAINT SHALL BE CARRIED BEHIND BUNKERS TO FINISHED FLOOR OR BASE.

ALL DOORS AND FRAMES ON THE SALES FLOOR SHALL BE PAINTED THE SAME COLOR ON THE BACK AND EDGES AS THE FRONT UNLESS NOTED OTHERWISE. ALL APPLIED WOOD BASES, DOORS, TRIMS, MOLDINGS AND FRAMED OPENINGS SHALL BE SEMI-GLOSS ENAMEL TO MATCH ADJACENT FINISHES UNLESS NOTED OTHERWISE. ALL FIXTURE WORK SHALL BE SATIN ENAMEL UNLESS NOTED OTHERWISE. 10. ALL STANDARDS AND GRILLS SHALL BE PAINTED WITH ENAMEL TO MATCH ADJACENT FINISH UNLESS NOTED OTHERWISE. 11. ALL PAINT AND/OR WALLCOVERING SHALL CONTINUE TO THE CEILING LINE WHEN EGG CRATE AND PLEXI LENS DO NOT EXIST. 12. ALL PAINT ON LAMINATE BUNKERS TO BE PRIMED WITH SW EXTREME BOND B51W00150

PLASTIC LAMINATE SHALL BE USED IN MAXIMUM LENGTH PIECES TO ELIMINATE SEAMS. ALL SEAMS SHALL BE EVEN AND FLAT WHEN THEY ARE NECESSARY. VERTICAL SEAMS SHALL BE LOCATED AT RECESSED STANDARDS ONLY.

HORIZONTAL SEAMS SHOULD NOT BE REQUIRED. ALL CABINET INTERIORS SHALL BE MELAMINE TO MATCH THE EXTERIOR PLASTIC LAMINATE. IF THE MELAMINE COLOR IS NOT SPECIFIED, THE CONTRACTOR MUST SUBMIT 6" X 9" SAMPLES FOR APPROVAL. 6. ALL WOOD GRAIN ON PERIMETER AND FREESTANDING FIXTURES SHALL RUN VERTICALLY EXCEPT AS NOTED OTHERWISE ON DRAWINGS. ALL DOORS SPECIFIED AS PLASTIC LAMINATE SHALL BE MATTE FINISH AND SHALL BE LAMINATED THE SAME COLOR ON THE BACK AND EDGES AS THE FRONT UNLESS NOTED

1. MATERIAL SHALL BE SPACED BETWEEN STANDARDS SO THAT THERE ARE NO SEAMS AND PATTERN MATCH MUST BE PERFECT TO ADJACENT SIDES. 2. NO HORIZONTAL SEAMS ARE ACCEPTABLE. MATERIAL MUST BE A FULL DROP EACH

3. ALL FABRIC EDGES SHALL BE FINISHED CLEANLY AND PROPERLY ON THE WALL. NO FRAYING AND/OR PILLING IS ACCEPTABLE. 4. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL MATERIAL TAKE-OFFS AND THE CORRECT BACKING FOR EACH FABRIC TO USED AS WALLCOVERING. 5. FLAMEPROOFING SHALL BE PROVIDED BY THE CONTRACTOR AS REQUIRED BY LOCAL CODE REGULATIONS. 6. ALL MATERIAL SHALL CARRY BEHIND BUNKERS TO THE BASE AND BEHIND VALANCES, CURTAINS, ETC TO THE CEILING HEIGHT. 7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR NOTIFYING THE RESOURCE THAT THEY ARE PURCHASING FOR A MACY'S INC PROJECT TO RECEIVE ANY PRICING AND LEAD

1. CONTRACTOR SHALL SUBMIT (4) 9" X 10" SAMPLES FOR EACH VENEER AND/OR HARDWOOD SPECIFIED FOR PROJECT. RELATED VENEER AND HARDWOOD SUBMITTALS MUST BE SUBMITTED TOGETHER. ALL SAMPLES SHALL BE ISSUED TO THE ARCHITECT FOR REVIEW AND APPROVAL. 2. ALL WORKMANSHIP MUST COMPLY WITH THE ARCHITECTURAL WOODWORK INSTITUTE CUSTOM QUALITY STANDARDS. WHEN A FLITCH NUMBER IS PROVIDED, VENEER MUST BE ORDERED BY FLITCH NUMBER AND VENEER RESOURCE AS SPECIFIED. IF A FLITCH NUMBER IS NOT PROVIDED, A+ GRADE VENEER IS REQUIRED. 4. VENEER FOR FREE-STANDING FIXTURES IS TO BE SLIP MATCHED AND SEQUENCE

MATCHED UNLESS NOTED OTHERWISE. 5. VENEER FOR PERIMETER APPLICATIONS AND DESIGNATED AS FLAT-CUT OR FLAT-SAWN SHALL BE BOOK MATCHED UNLESS NOTED OTHERWISE. 6. VENEER FOR PERIMETER APPLICATIONS AND DESIGNATED AS QUARTER CUT SHALL BE SLIP MATCHED UNLESS NOTED OTHERWISE. 7. VENEER FOR PERIMETER AND PANEL APPLICATIONS SHALL BE BOOK MATCHED, CENTER MATCHED AND SEQUENCE MATCHED. 8. THE CONTRACTOR IS REQUIRED TO FOLLOW THE TR-4 CONVERSION VARNISH PREMIUM GRADE AS DEFINED BY AWI, 7TH EDITION, SECTION 1500.



STORE ENVIRONMENT Store Planning • Architecture Construction • Engineering 145 Progress Place Springdale, OH 45246



16 East 12th Street, Cincinnati OH 45202 (513) 549-6879 architecture359.com



7	PLAN REVISIONS	9/21/2022
<u> </u>	BULLETIN 1	07/19/22
A	TI BID & PERMIT	05/5/22
NO.	REVISIONS	DATE
STORE		*



PROJECT NO. XXXXXXXX DATE DRAWN BY CHECKED BY


SHEET TITLE


SHEET NO.


SCALE

SECTIONS, DETAILS & FINISH **SPECIFICATIONS** 


2-11

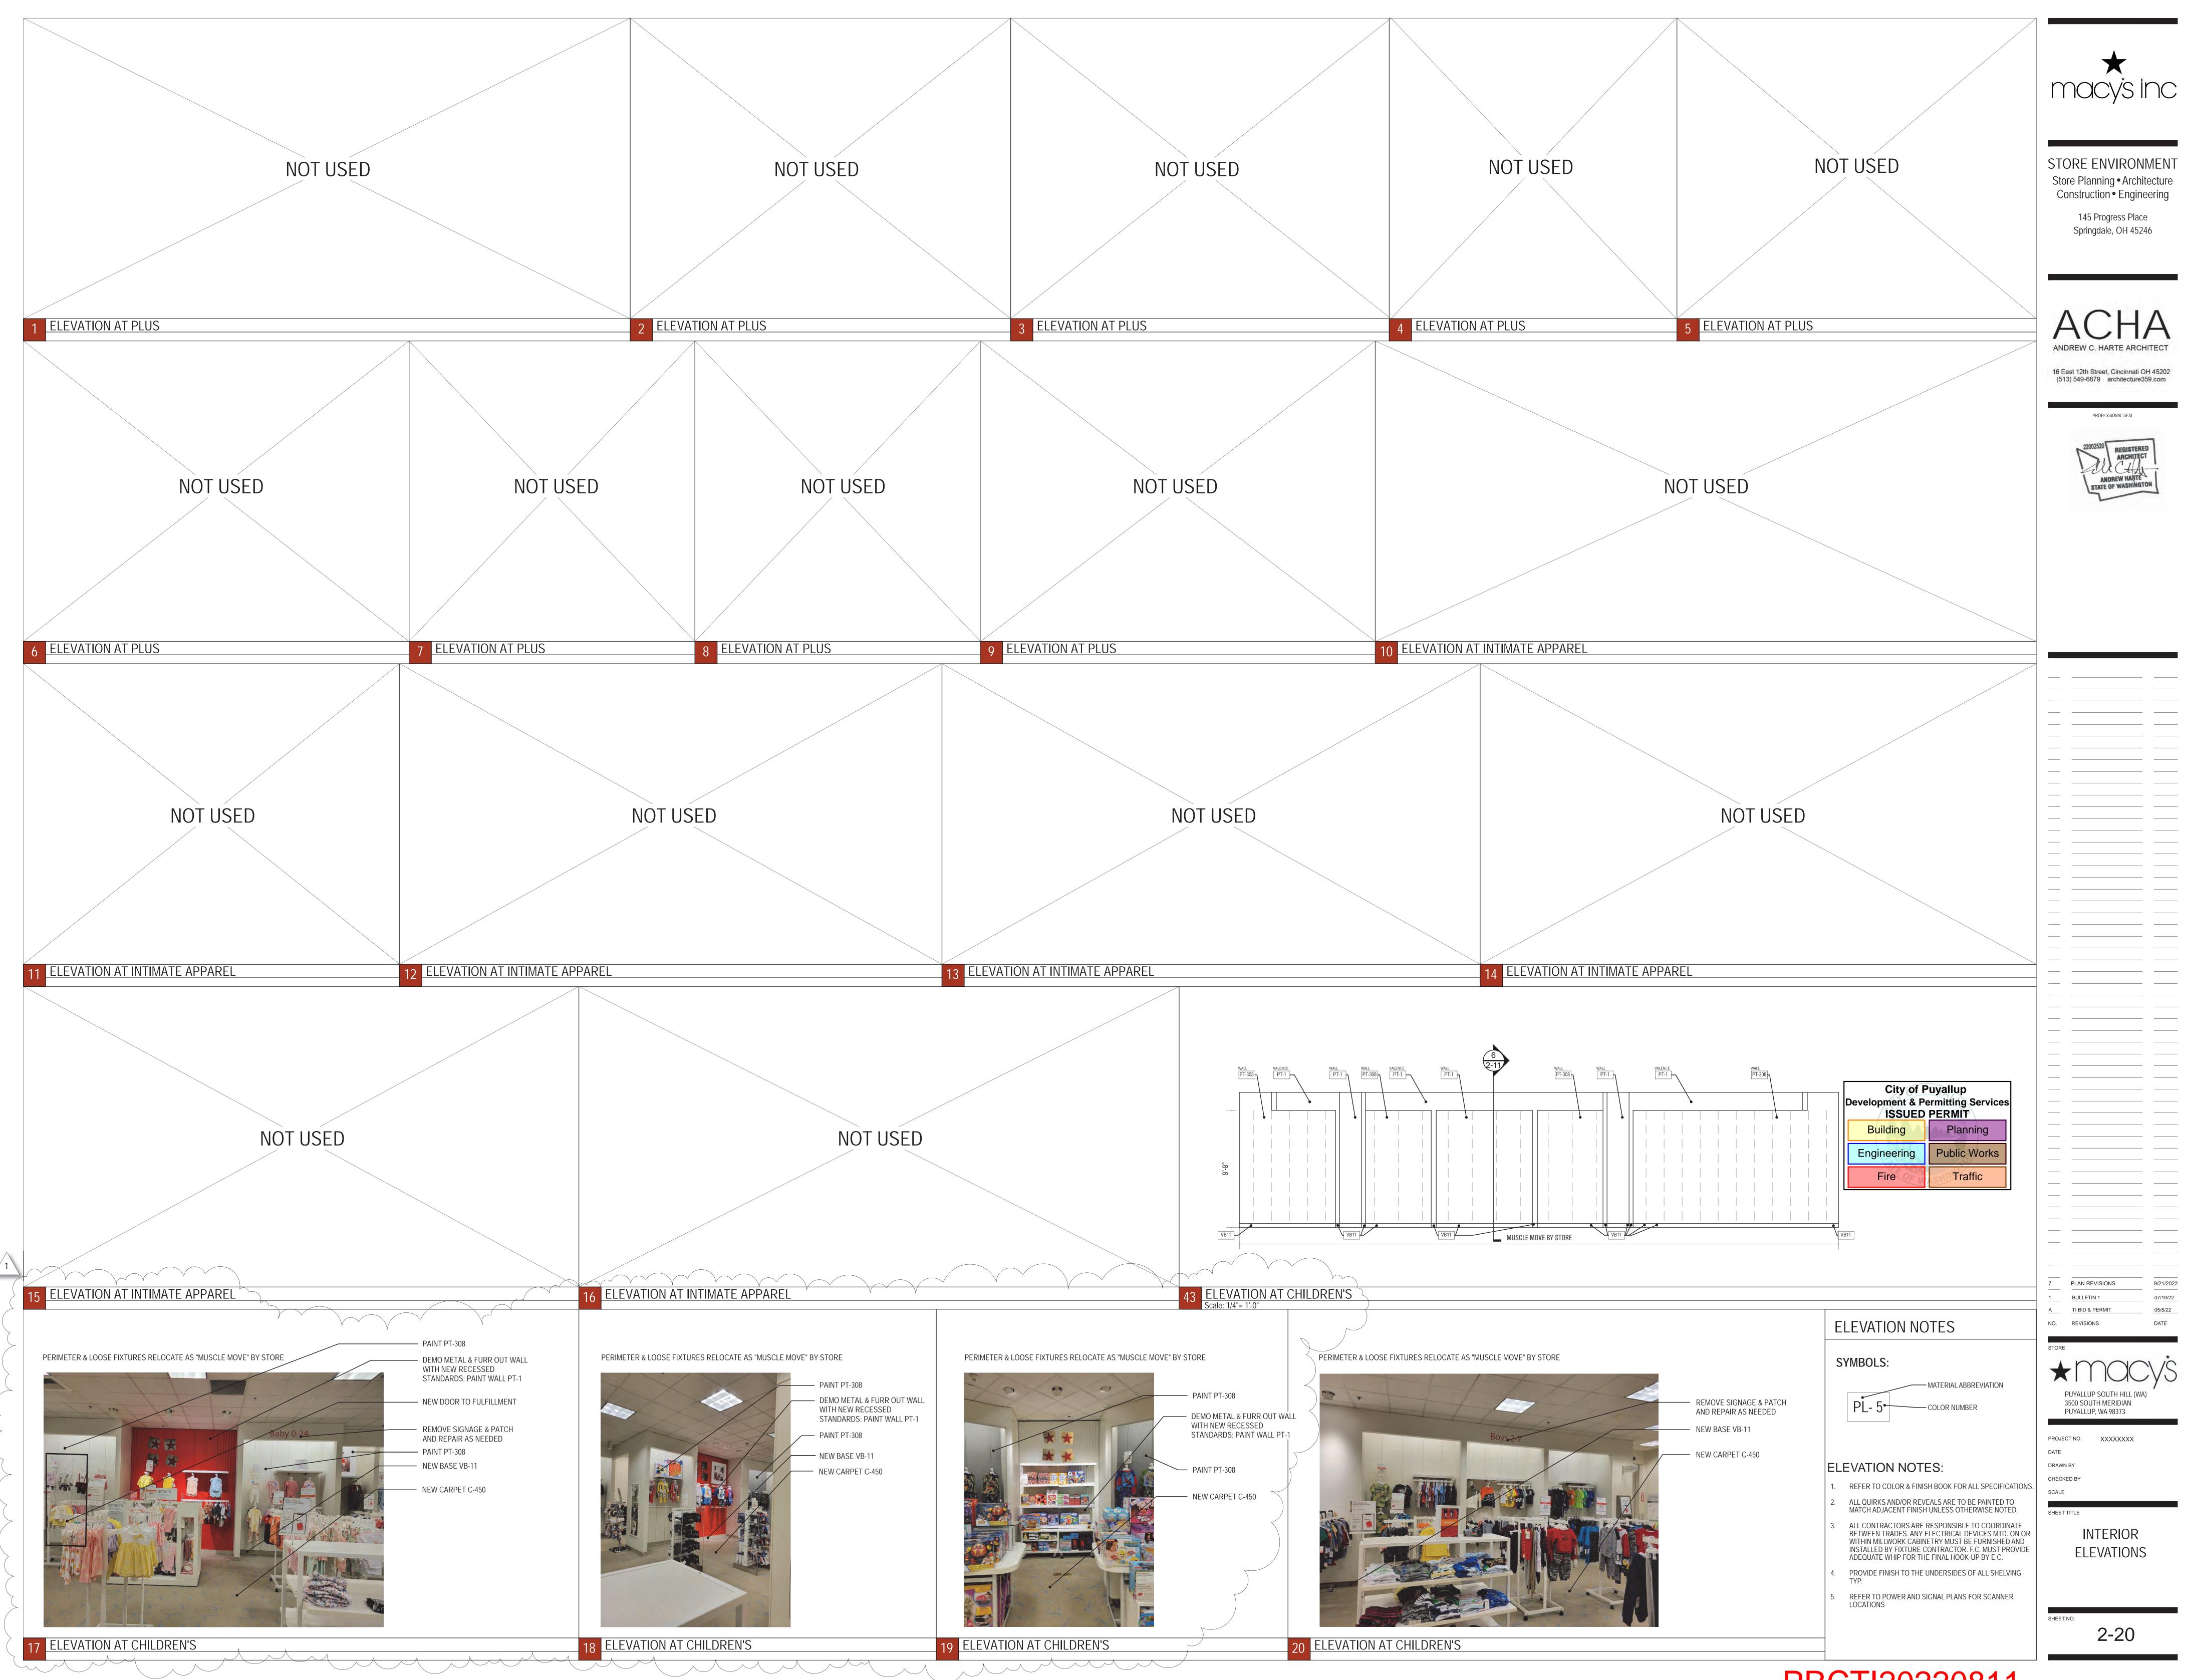


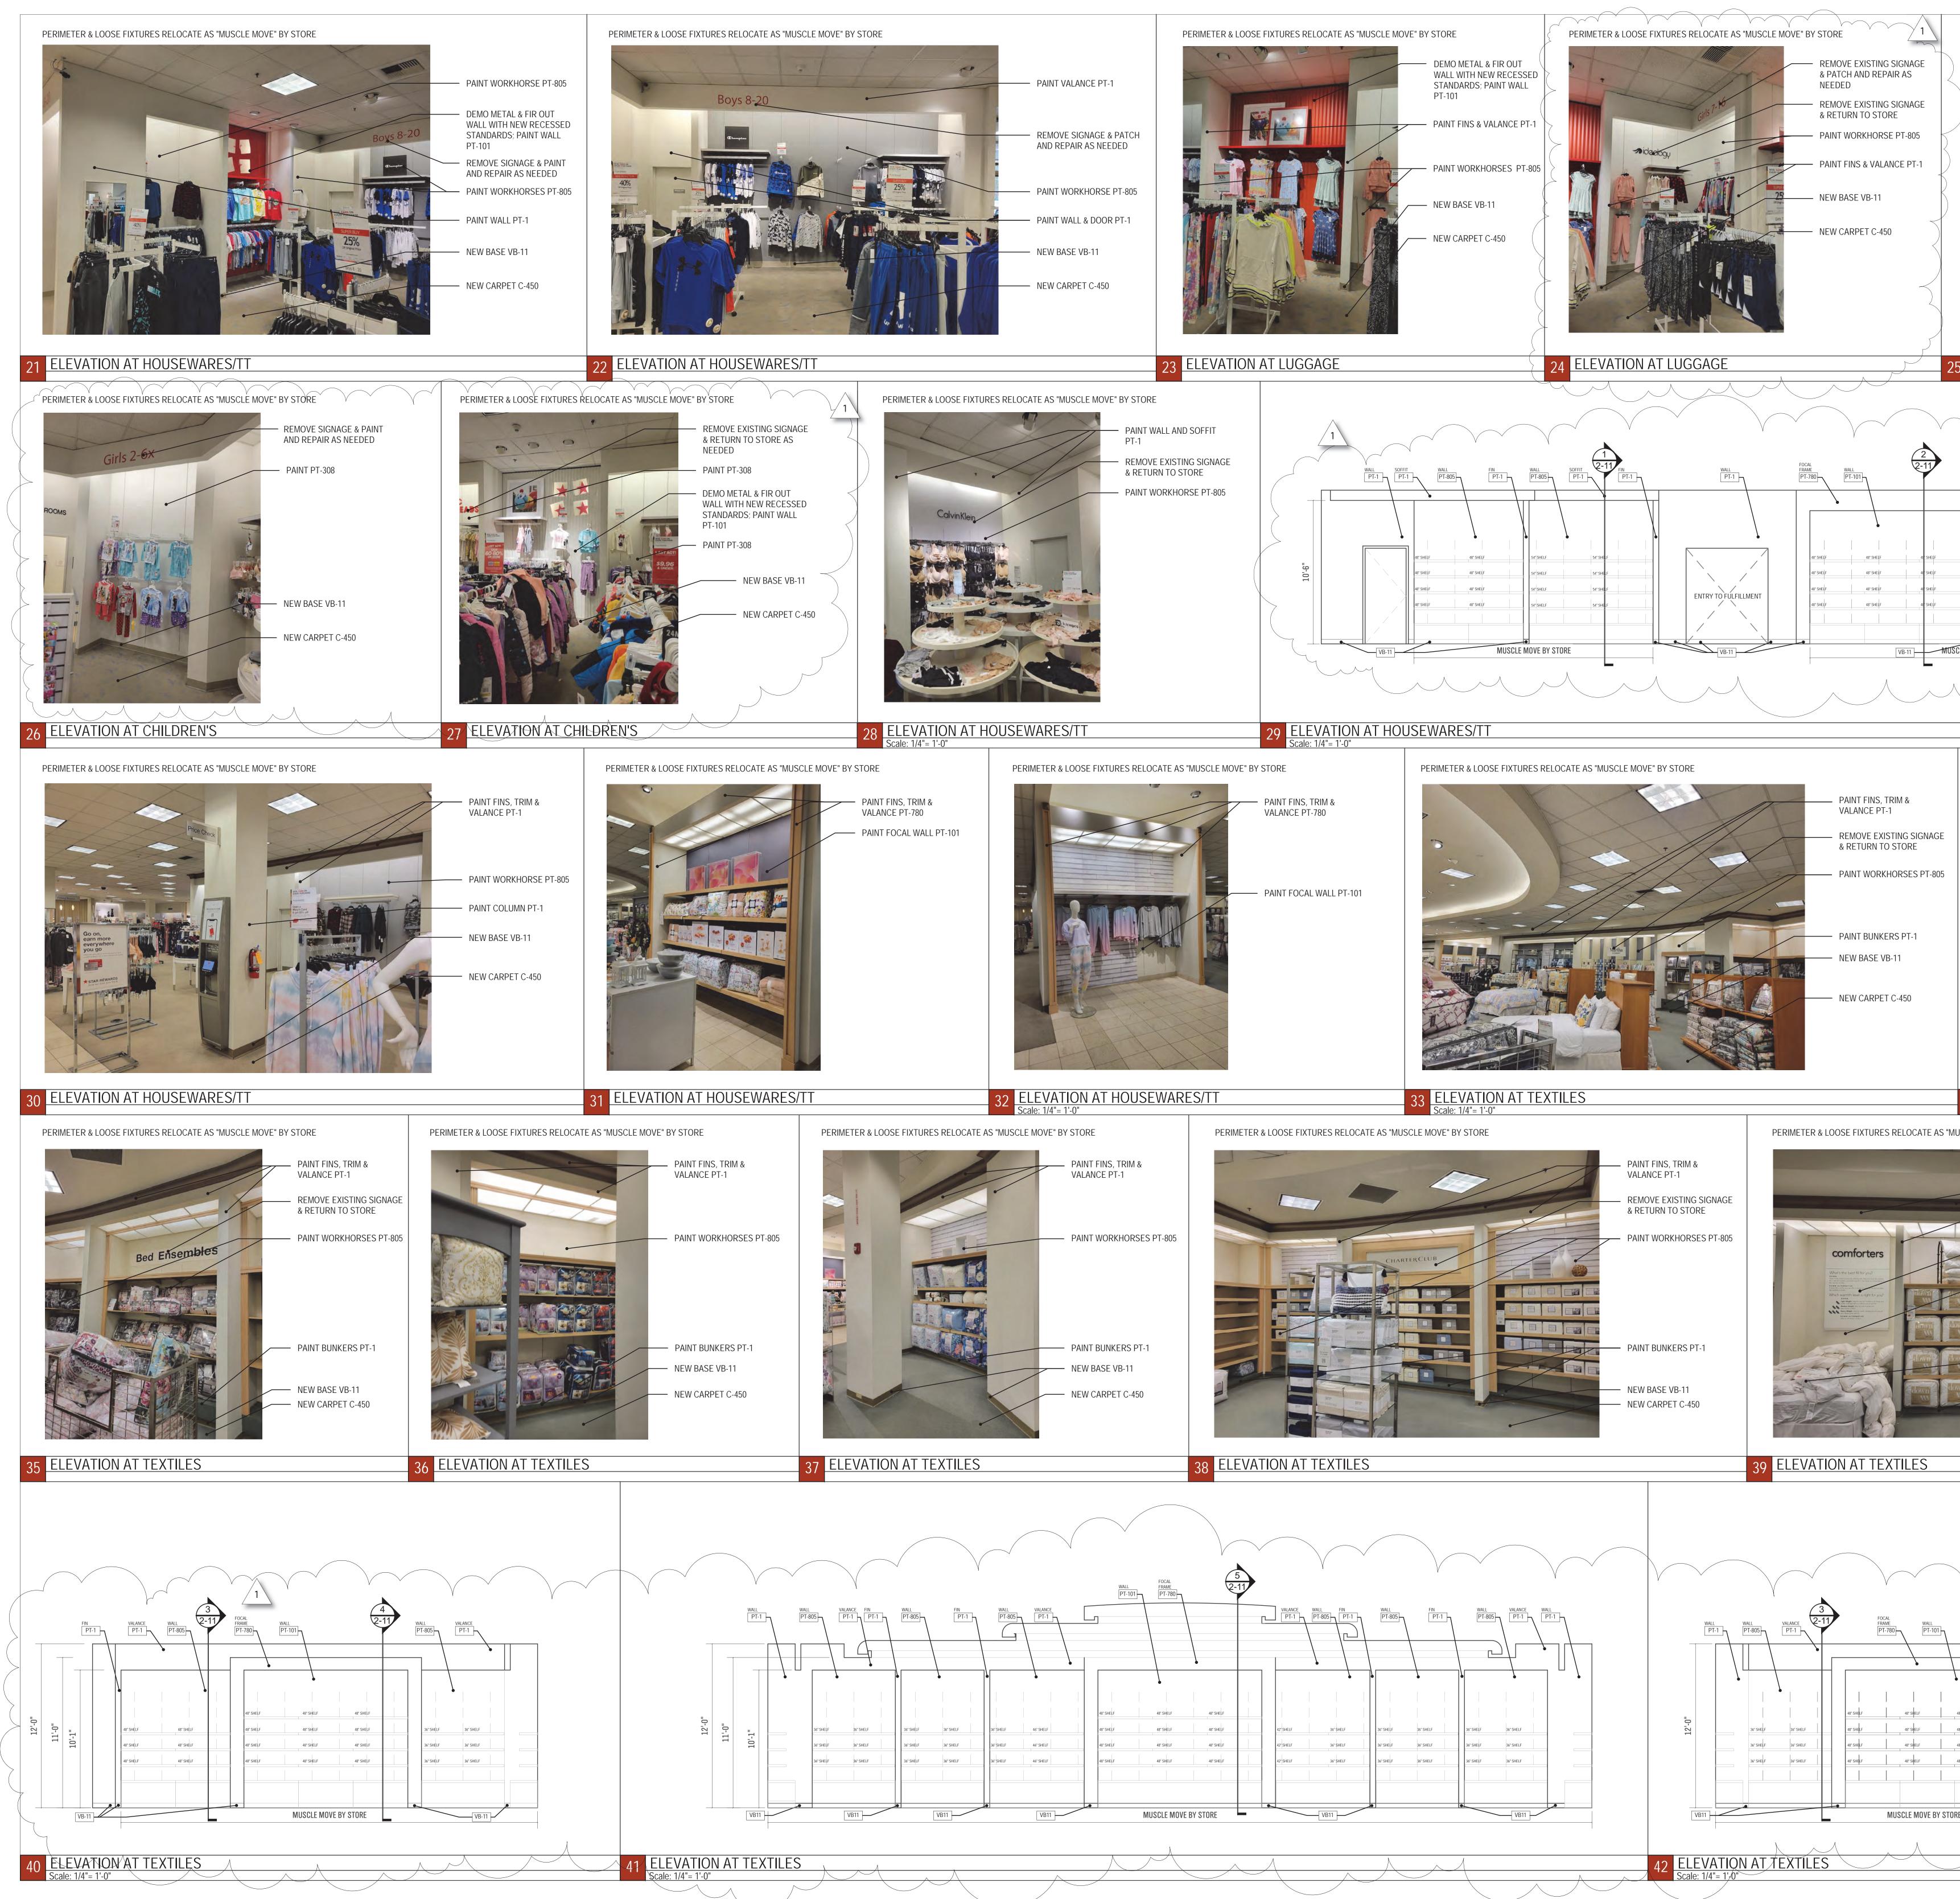

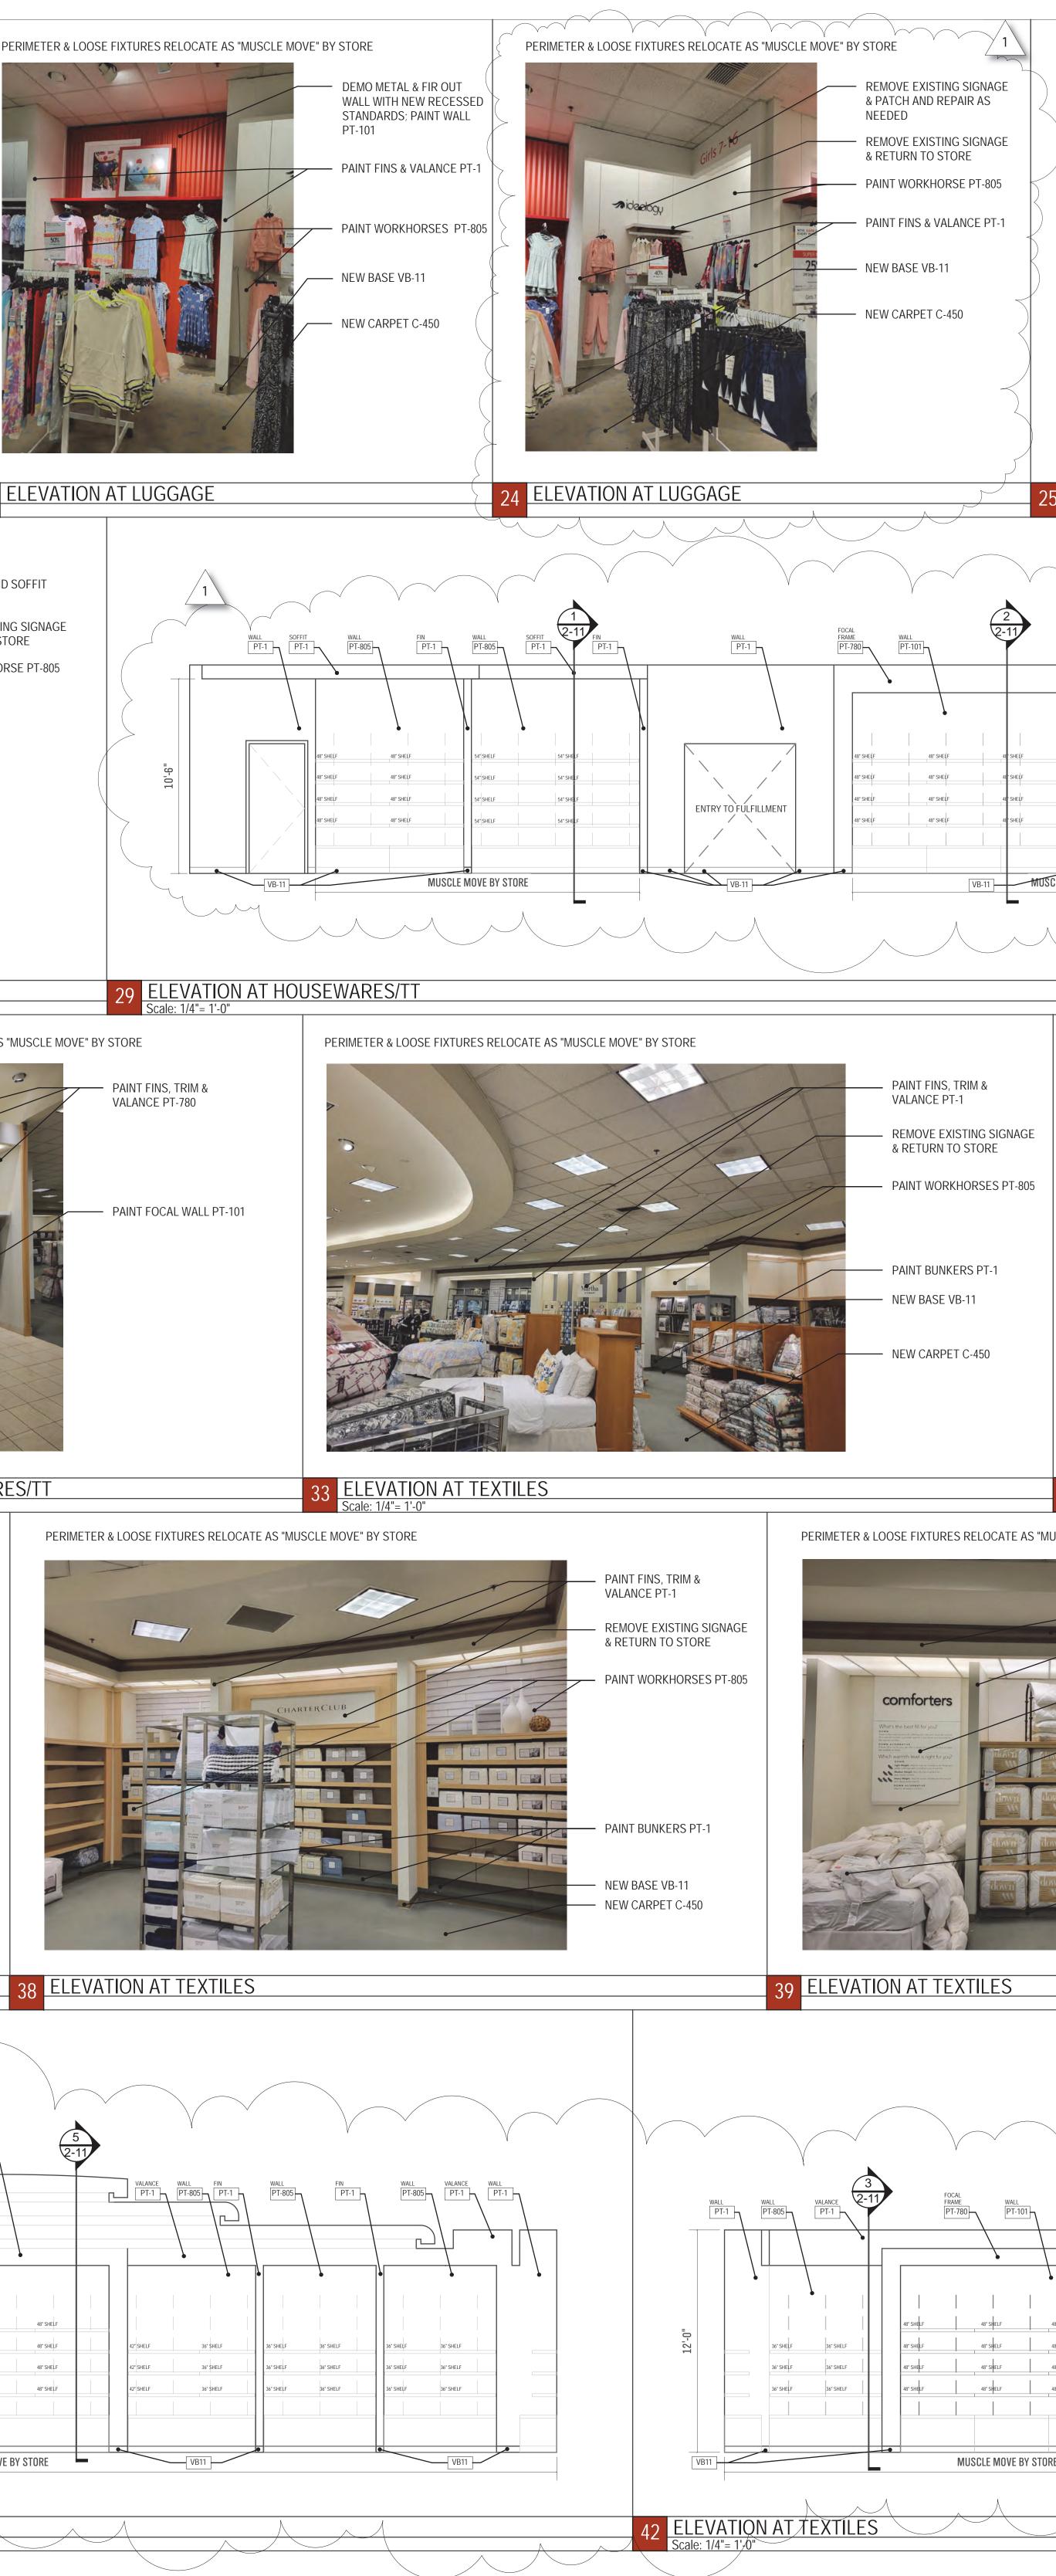


	OVE" BY STORE — NEW BASE VB-11 — NEW CARPET C-450	<section-header>Image: A construction of the c</section-header>
ELEVATION AT CHILDREN'S		<text><text><text><text></text></text></text></text>
<image/> <image/> <section-header></section-header>	PAINT FINS, TRIM & VALANCE PT-1 PAINT WORKHORSES PT-805 NEW BASE VB-11 NEW CARPET C-450	
<section-header></section-header>	<ul> <li>PAINT FINS, TRIM &amp; VALANCE PT-1</li> <li>REMOVE EXISTING SIGNAGE &amp; RETURN TO STORE</li> <li>PAINT WORKHORSES PT-805</li> <li>PAINT BUNKERS PT-1</li> <li>NEW BASE VB-11</li> <li>NEW CARPET C-450</li> </ul>	
Development &	Traffic	1       BULLETIN 1       07/19/22         A       TIBID & PERMIT       05/5/22         NO       REVISIONS       DATE         STORE <b>WOUCOUS WYALLUP SOUTH HILL (WA)</b> STORE <b>WYALLUP SOUTH HILL (WA)</b> JOUS SOUTH MERIDIAN         PUYALLUP SOUTH HILL (WA)         SOUTH MERIDIAN         DYALLUP SOUTH MERIDIAN         DYALLUP SOUTH MERIDIAN         JOUS SOUTH MERIDIAN         DYALLUP SOUTH MERIDIAN         DYALLUP SOUTH MERIDIAN         DYALLUP SOUTH MERIDIAN         DYALUP SOUTH MERIDIAN         DYALUP SOUTH MERIDIAN         DYALUP SOUTH MERIDIAN         ROJECT NO.         SOLE

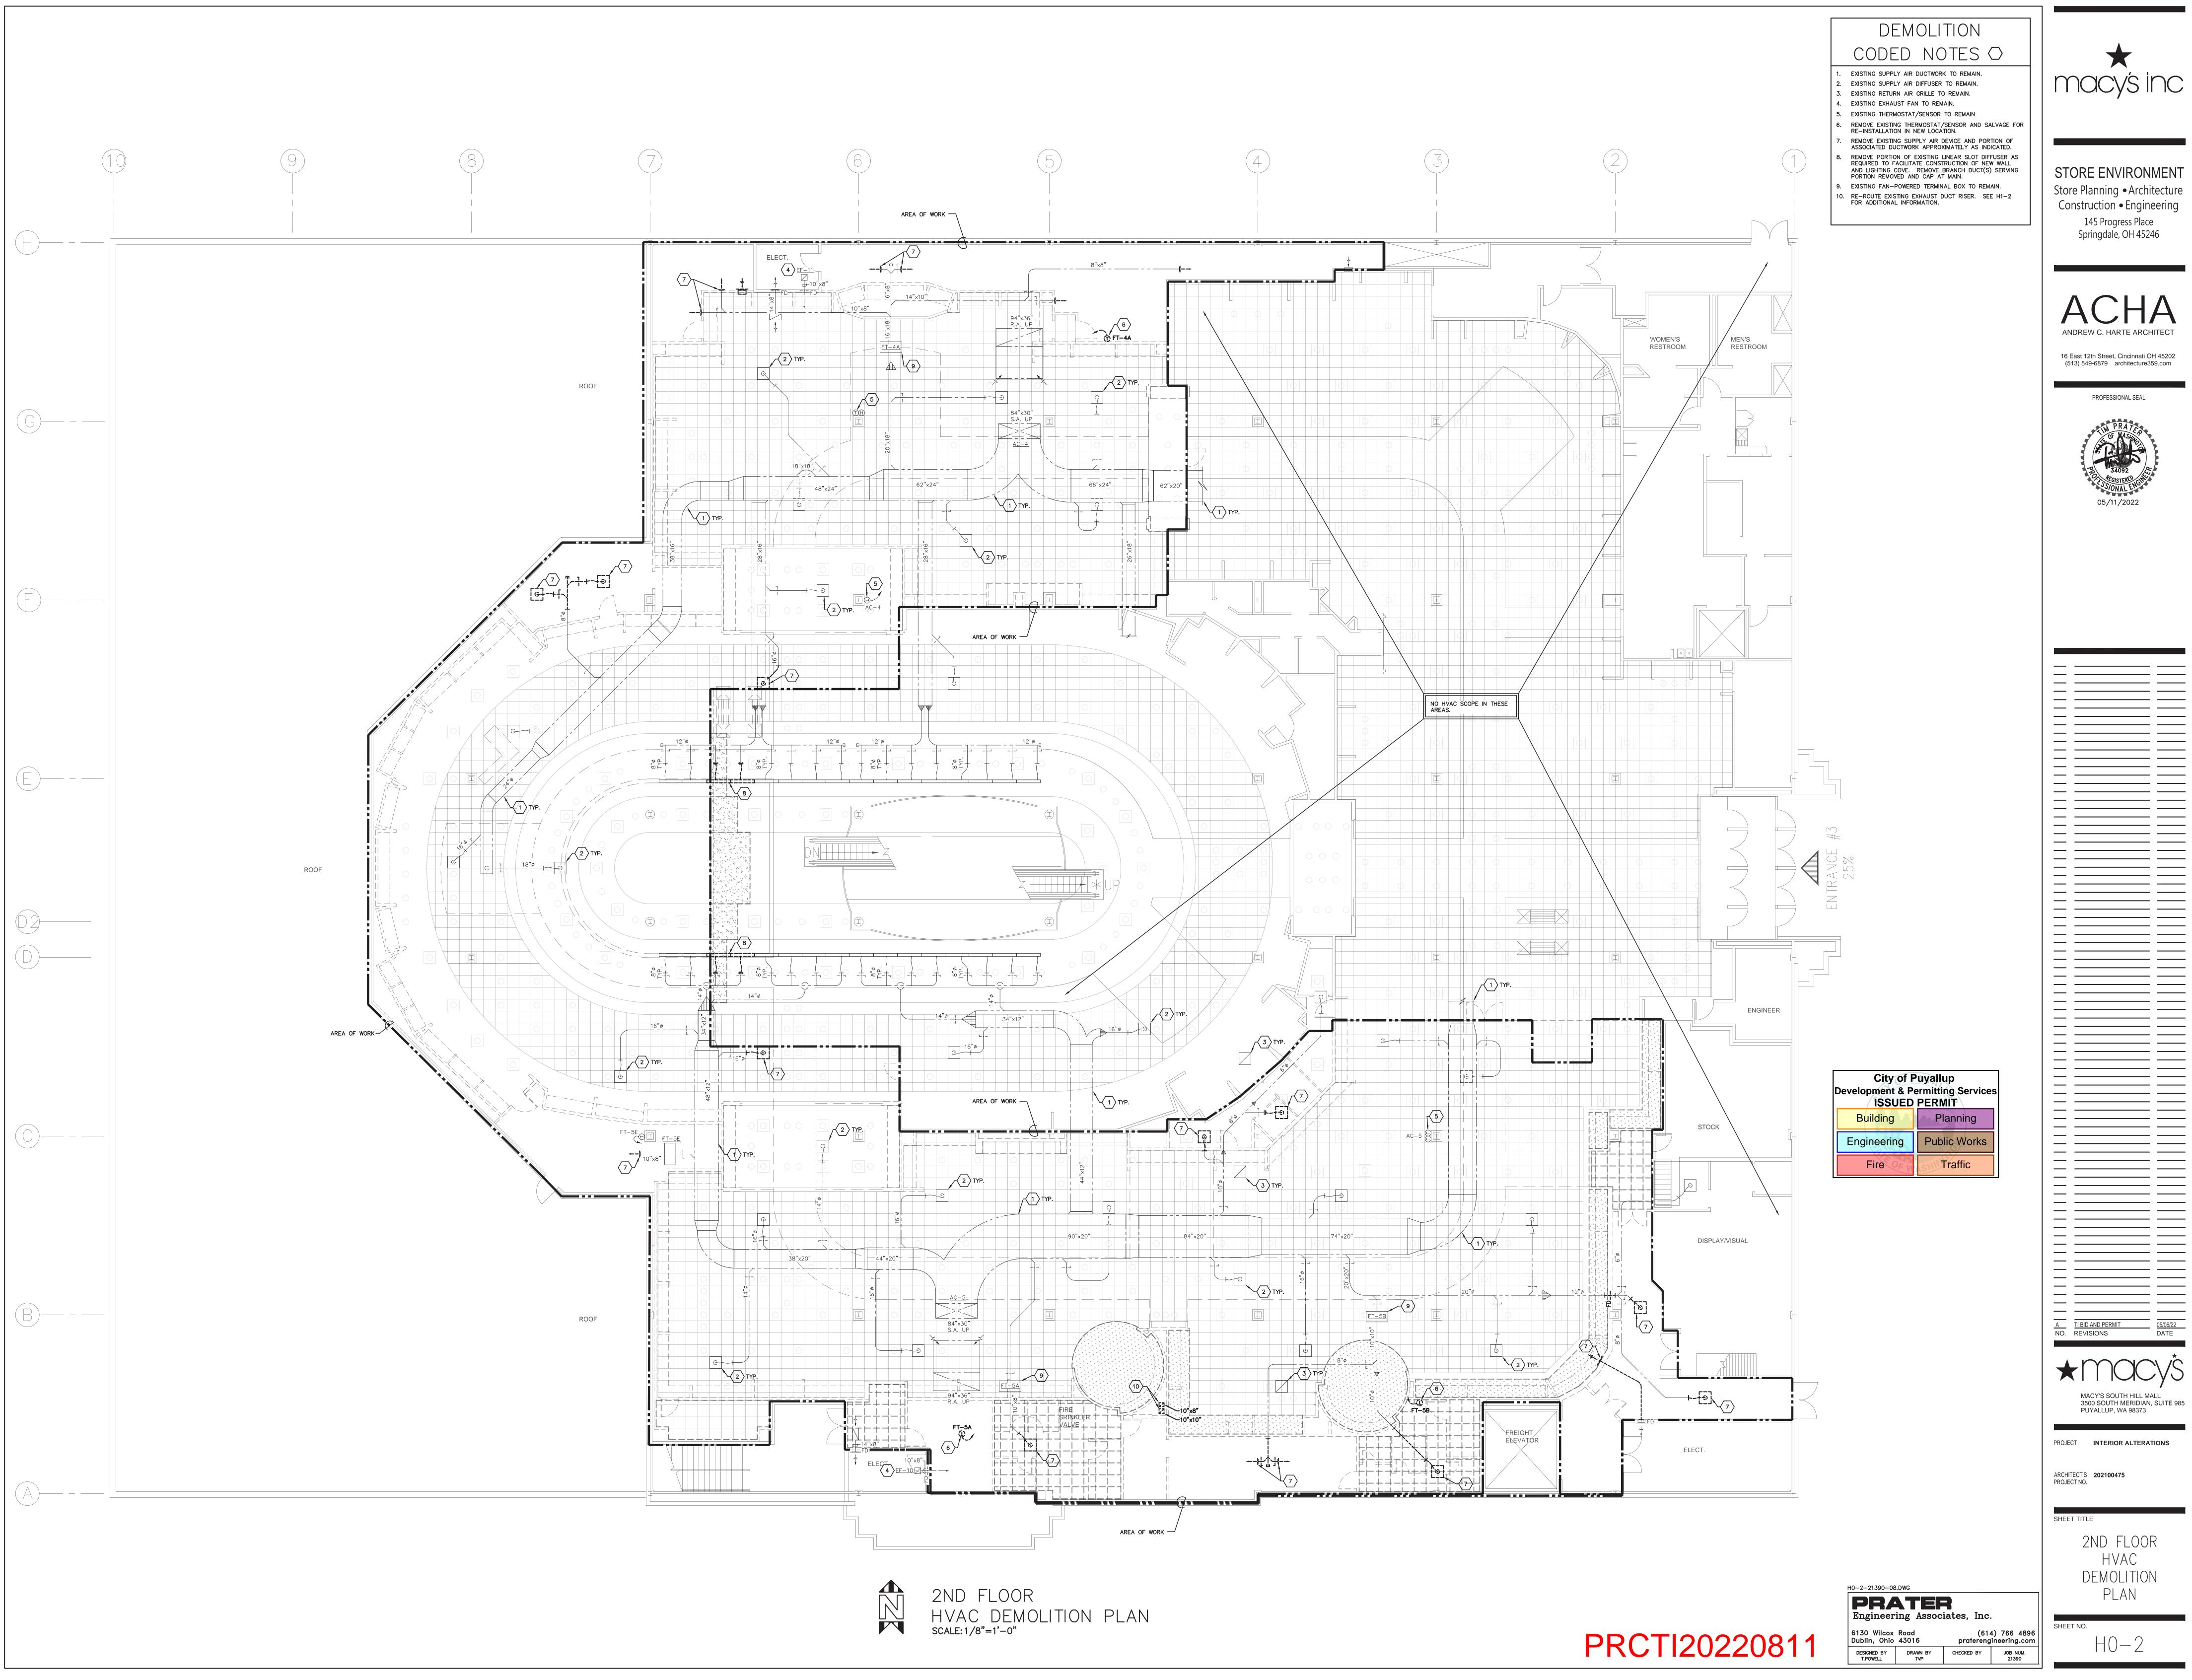

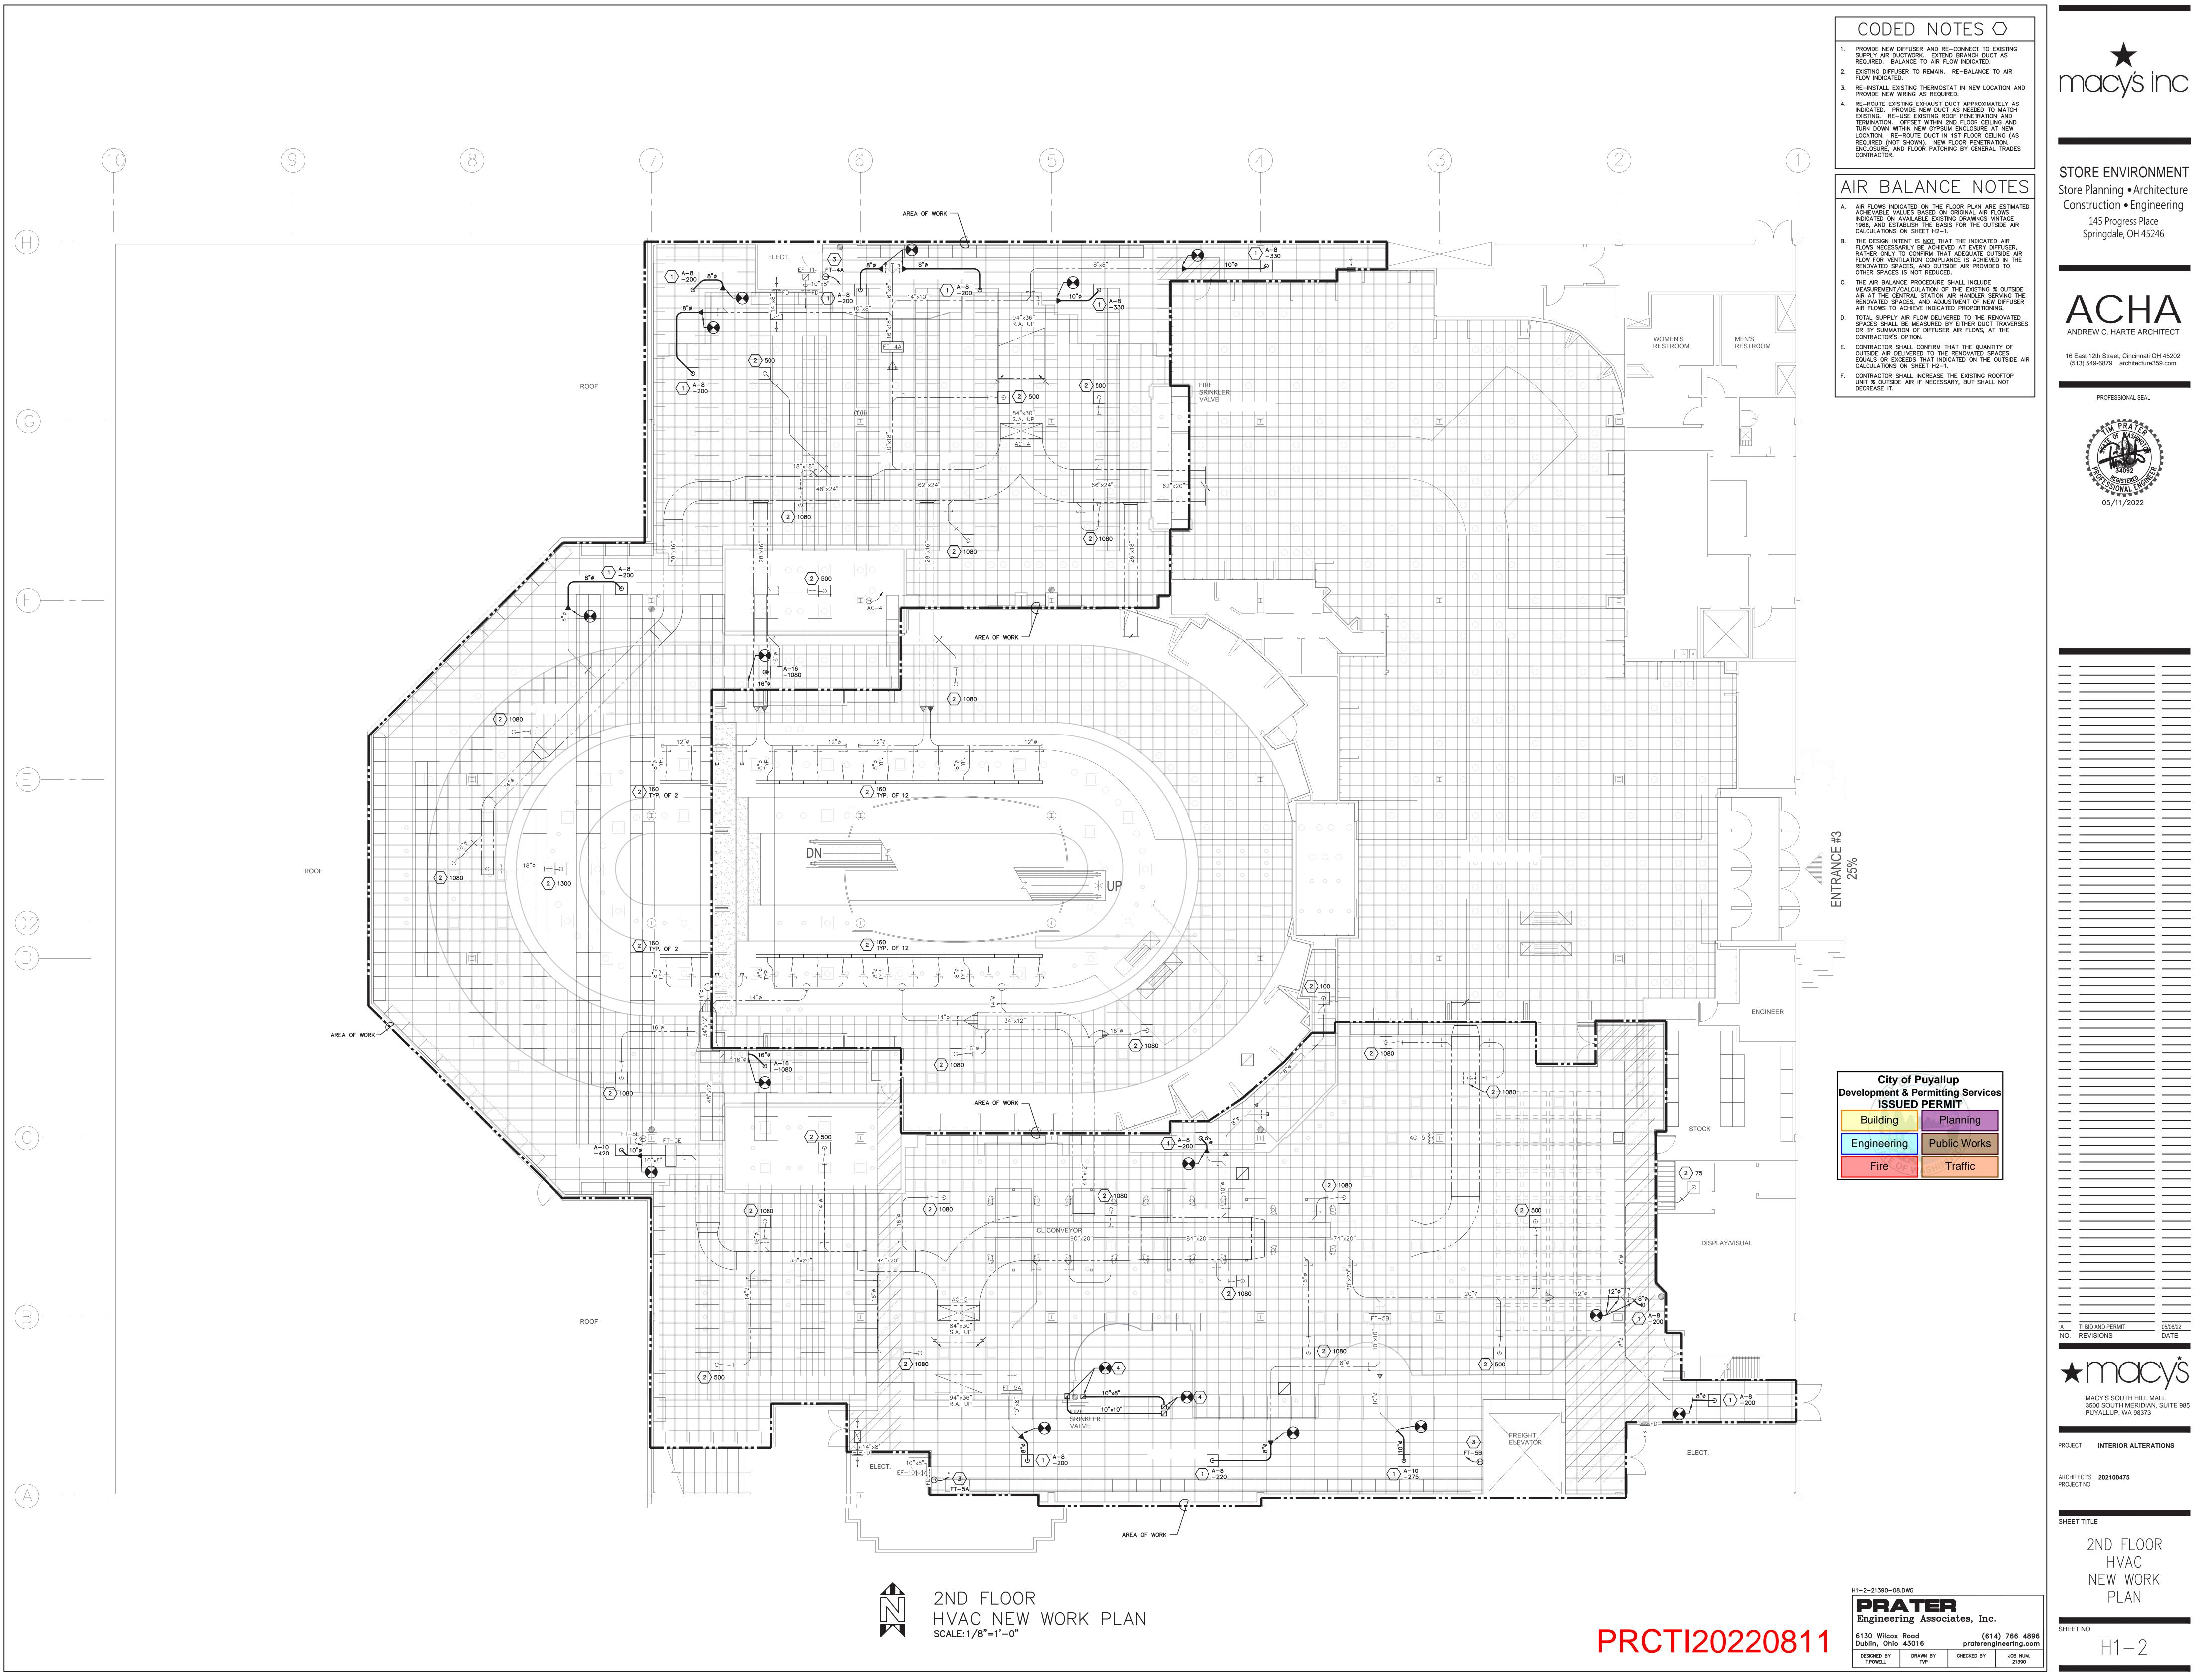







	Multi Zone Recircu	lating System			ASHRAE 62.1-2016 Ve	entilation Rate P	Procedure						Design	Case: Heating					
		Pz	Az	Rp	Ra	Rp*Pz	Ra*Az	Rp*Pz + Ra*Az	Ez	Voz	Vpz		Er	Vdz	Zpz	Fb = Ep	Fa	Fc	Evz
Room Name	Occupancy Category	Zone Population (# of people)	Zone Floor Area (SF)	People O.A. Required (cfm / person)	Area O.A. Required (cfm / SF)	People Outside Air Component (cfm)	Area Outside Air Component (cfm)	Breathing Zone Outdoor Airflow (cfm)	Zone Air Distribution Effectiveness	Zone Outdoor Airflow (cfm)	Zone Primary Airflow (cfm)	Recirculated Airflow (cfm)	Fraction of Recirculated Representative of System Return Air	Zone Discharge Airflow (cfm)	Primary Outdoor Air Fraction	Primary Air Fraction to the Zone	Fraction of Supply Air to zone from sources outside the zone	Fraction of outdoor air to the zone from sources outside the zone	Zone Ventilation Efficiency
	Warehouses	40	22770	10	0.06	400	1367	1767	0.8	2209	28990	0	0.00	28990	0.08	1.00	1.00	1.00	0.97
System Totals:		Sum of Zone Populations 40.0	Sum of Zone Areas 22,770			Sum of People Outdoor Air Components 400	Sum of Area Outdoor Air Components 1367	-			Vps - System Primary Airflow (cfm) 35430								
O.A. Fraction	1	0.08																	
tion Efficiency (Table 6.2.5.2)		0.99																	
tion Efficiency (Appendix A)		0.97																	
f Pz)		40 people																	
		40 people																	
		1.00																	
Outdoor Air Intake		1767 cfm																	
oor Air Fraction		0.05																	
Required	8	1785 cfm																	
d		1800 cfm																	
r Square Foot		0.08 cfm/SF																	
ntilation Design		5.1%																	

	AIR TERMINAL SCHEDULE
	TYPE OF OUTLETA - 8 - 300AIR QUANTITY IN C.F.M. <u>ROUND AND</u> <u>SQUARE DIFFUSERS:</u> SIZE OF OUTLET (NECK SIZE DIAMETER FOR DIFFUSERS)AIR QUANTITY IN C.F.M. (DIFF. & REG. ONLY)
TYPE	DESCRIPTION
A	STEEL SQUARE 3-CONE SUPPLY DIFFUSER. 24"x24". FURNISH WITH EQUALIZING GRID AND PATERN CONTROLLERS. TITUS MODEL TMSA OR EQUAL.
В	STEEL RECTANGULAR LOUVERED RETURN/EXHAUST AIR GRILLE. SINGLE DEFLECTION, 3/4" SPACING, 35" DEFLECTION. TITUS MODEL 350RL OR EQUAL.

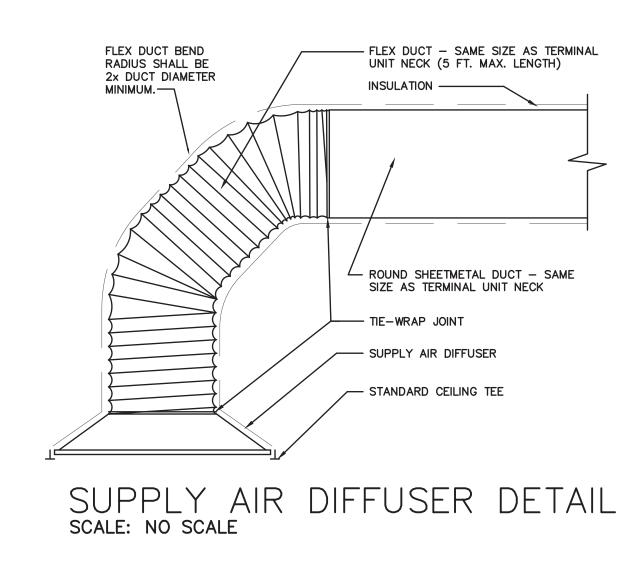



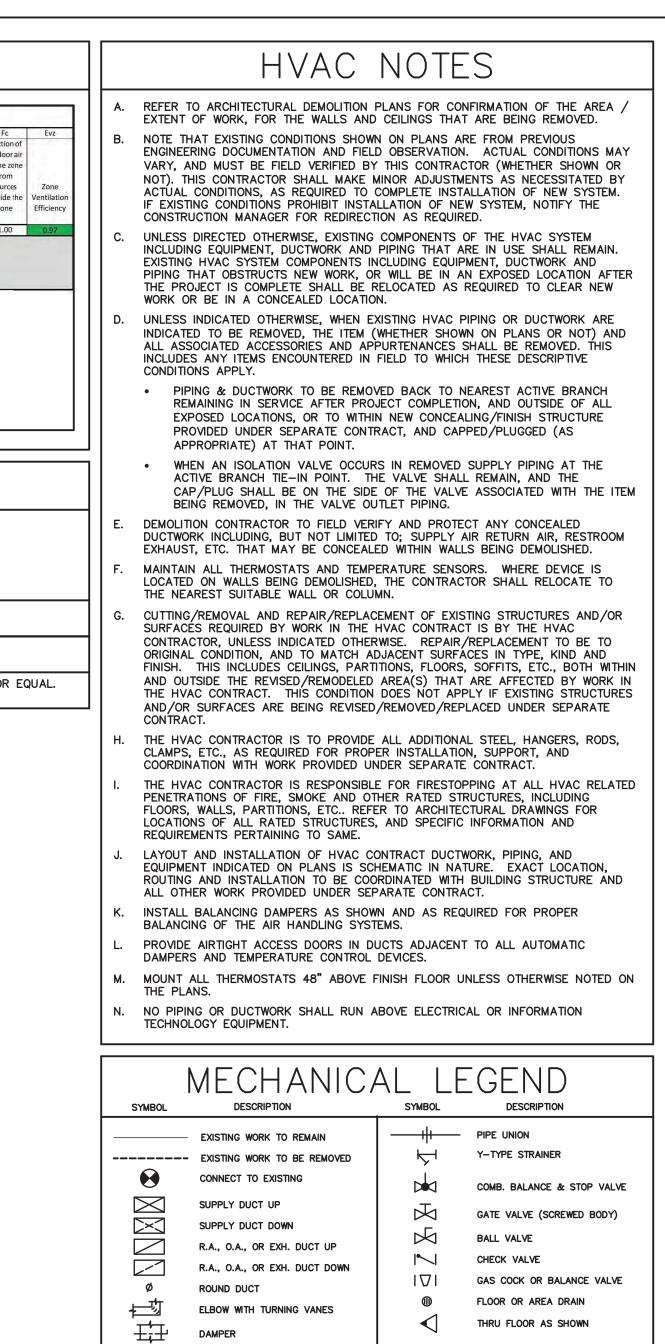

SPIN-IN FITTING WITH

T THERMOSTAT

\_\_\_\_\_\_\_ 45° BOOT BRANCH TAKEOFF

City of P Development & Po ISSUED	
Building	Planning
Engineering	Public Works
Fire OF W	Traffic

H2-1-21390-08	.DWG			
	ing Assoc	<b>a</b> tes, Inc.		
6130 Wilcox Dublin, Ohio		(61) pratereng	4) 766 4896 jineering.com	S
DESIGNED BY T.POWELL	DRAWN BY TVP	CHECKED BY	JOB NUM. 21390	







16 East 12th Street, Cincinnati OH 45202 (513) 549-6879 architecture359.com


PROFESSIONAL SEAL


—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
—		
_		
_		
_		
—		
—		
—		
_		
—		
—		
_		
_		
—		
—		
—		
—		
_		
		05/06/22
		  05/06/22 DATE
NO.		DATE
NO.	REVISIONS	DATE
NO.	REVISIONS MACY'S SOUTH HILL MA 3500 SOUTH MERIDIAN, PUYALLUP, WA 98373 CT INTERIOR ALTERAT	DATE
NO.	REVISIONS MACY'S SOUTH HILL MA 3500 SOUTH MERIDIAN, PUYALLUP, WA 98373 CT INTERIOR ALTERAT	DATE
NO.	REVISIONS MACY'S SOUTH HILL MA 3500 SOUTH MERIDIAN, PUYALLUP, WA 98373 CT INTERIOR ALTERAT	DATE
NO.	REVISIONS MACY'S SOUTH HILL MA 3500 SOUTH MERIDIAN, PUYALLUP, WA 98373 CT INTERIOR ALTERAT TECT'S 202100475 CT NO. T TITLE HVAC NOTES, SCHEDULES	DATE
NO.	REVISIONS MACY'S SOUTH HILL MA 3500 SOUTH MERIDIAN, PUYALLUP, WA 98373 TINTERIOR ALTERAT TECT'S 202100475 CT NO. TITLE HVAC NOTES, SCHEDULES AND DETAIL	DATE

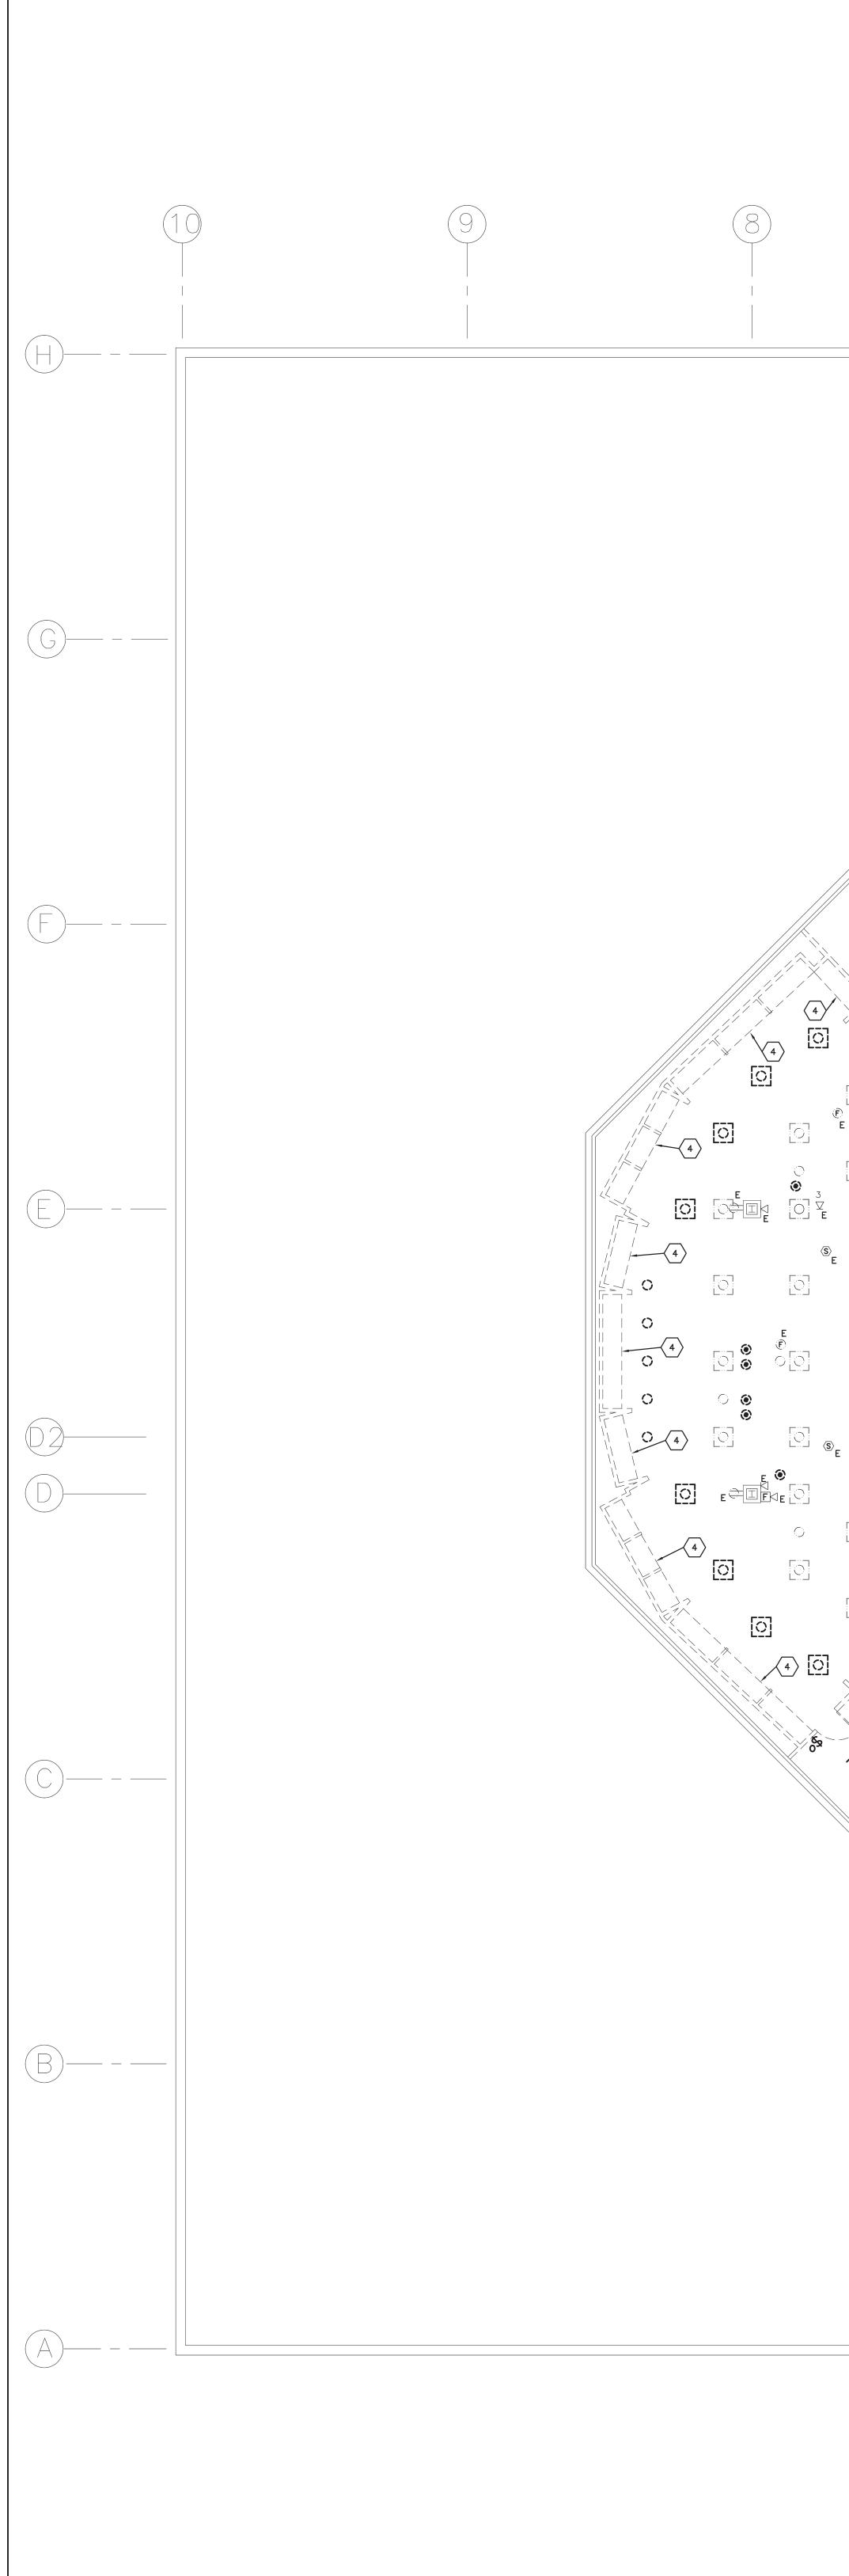


<u>EX. PANEL "2H"</u> —— <u>EX. PANEL "2G"</u> — 2J-1 2J-2 \_\_\_\_\_  $\checkmark'_{\prime} \mid \sqsubseteq - - - \Downarrow - - \dashv - - - - \dashv - -$ LF--0----4 \_\_\_\_ (4) E  $\textcircled{\textbf{O}}$ 0 0 <u>\_</u> |---+<u>-</u> F--0----H 00 ╒ ┍ ┍ ┍─────┥│**────**┥ \_\_\_\_\_ ╴┄<u>─</u>╴┣╼╼╼╼┫ ┣╼╼╼╼┫│╴┣╼╼╼╼┫ ╌┈╤┥**╴╸╸╸╸┥**┤**╴╸╸╸╸┥** ┣╼╼╼╼╼┫╎**╴╸┝**╼╼╼╼┥╵──╵<sup>╤</sup>┤  $\circ$   $[\circ]$   $\circ$ • E E F ----- TEMPORARY CONSTRUCTION  $\odot$   $\odot$ BARRIER WALL  $[ \bigcirc ]$ [] 00 00  $\begin{bmatrix} 0 \end{bmatrix} \begin{pmatrix} 4 \end{pmatrix}$ 0  $\begin{bmatrix} 0 \end{bmatrix}$ ᠂᠇᠆᠆᠆᠆ᠮᢓ F--0----H  $\bigcirc$ т Өт **s** ЕΕ 0 0 r Ø 0  $[ \bigcirc ]$  $[ \bigcirc ]$ ΕE EX. PANEL "2G" EX. PANEL "2C" 2ND FLOOR

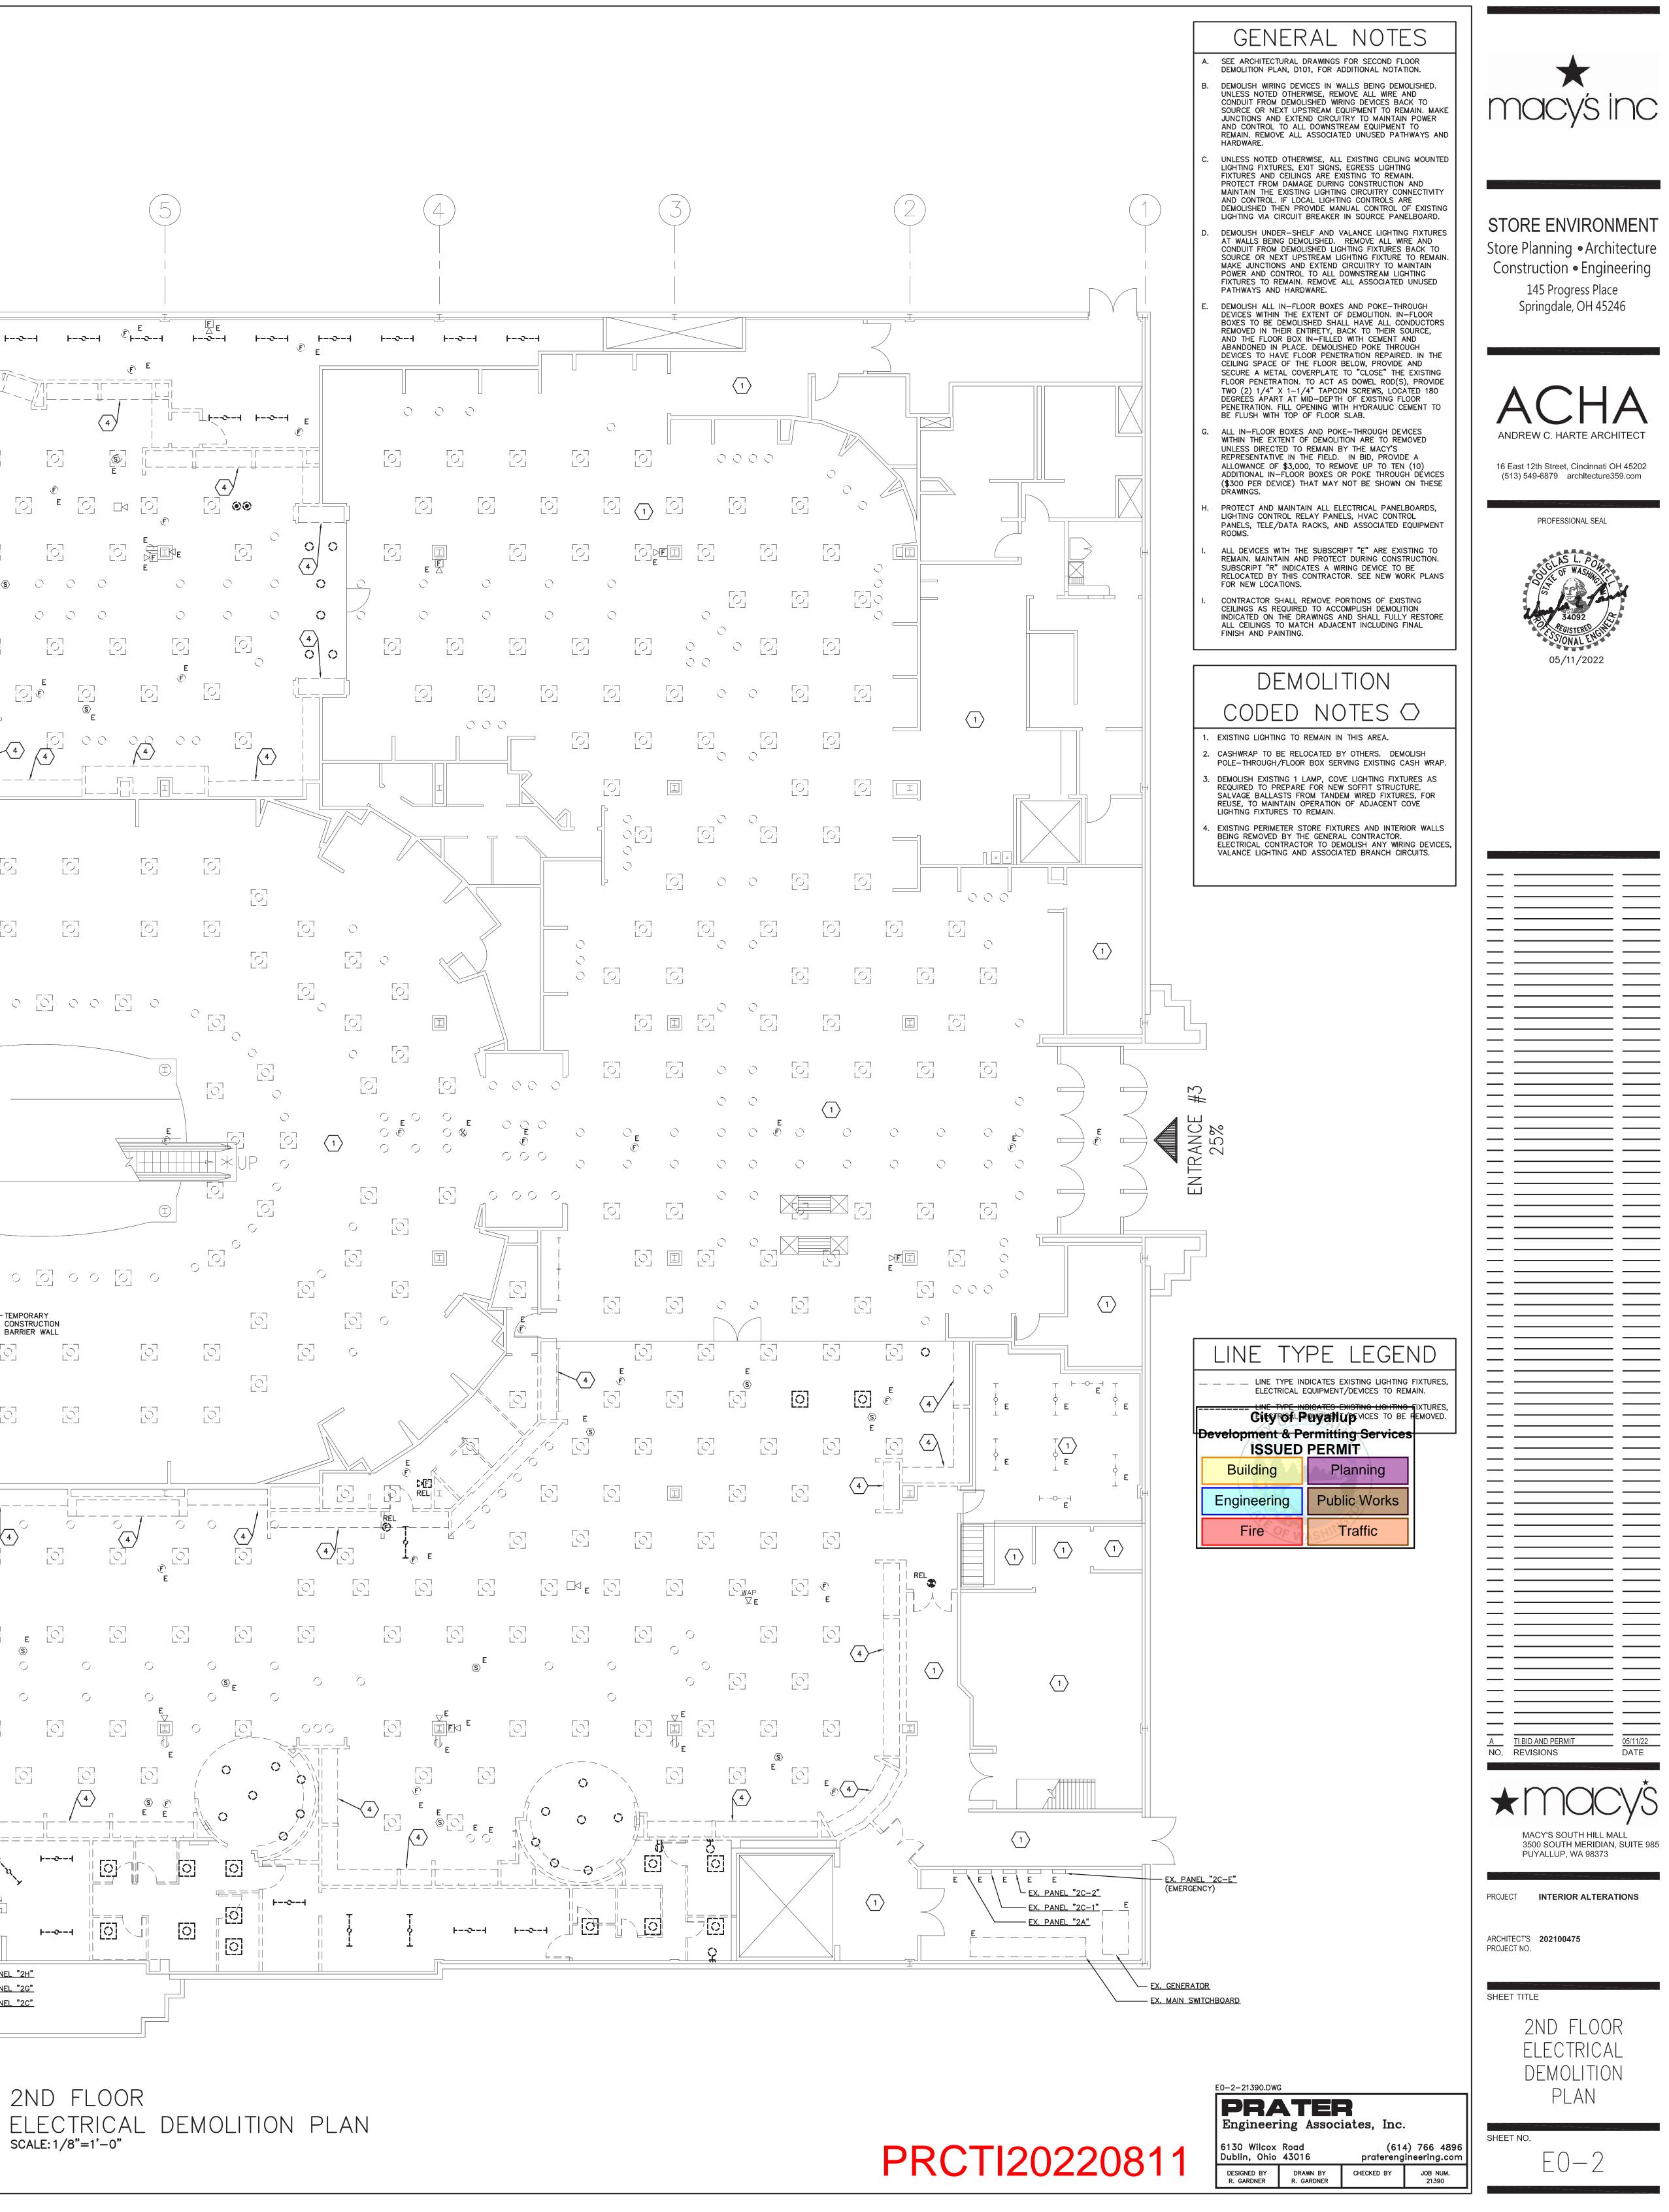

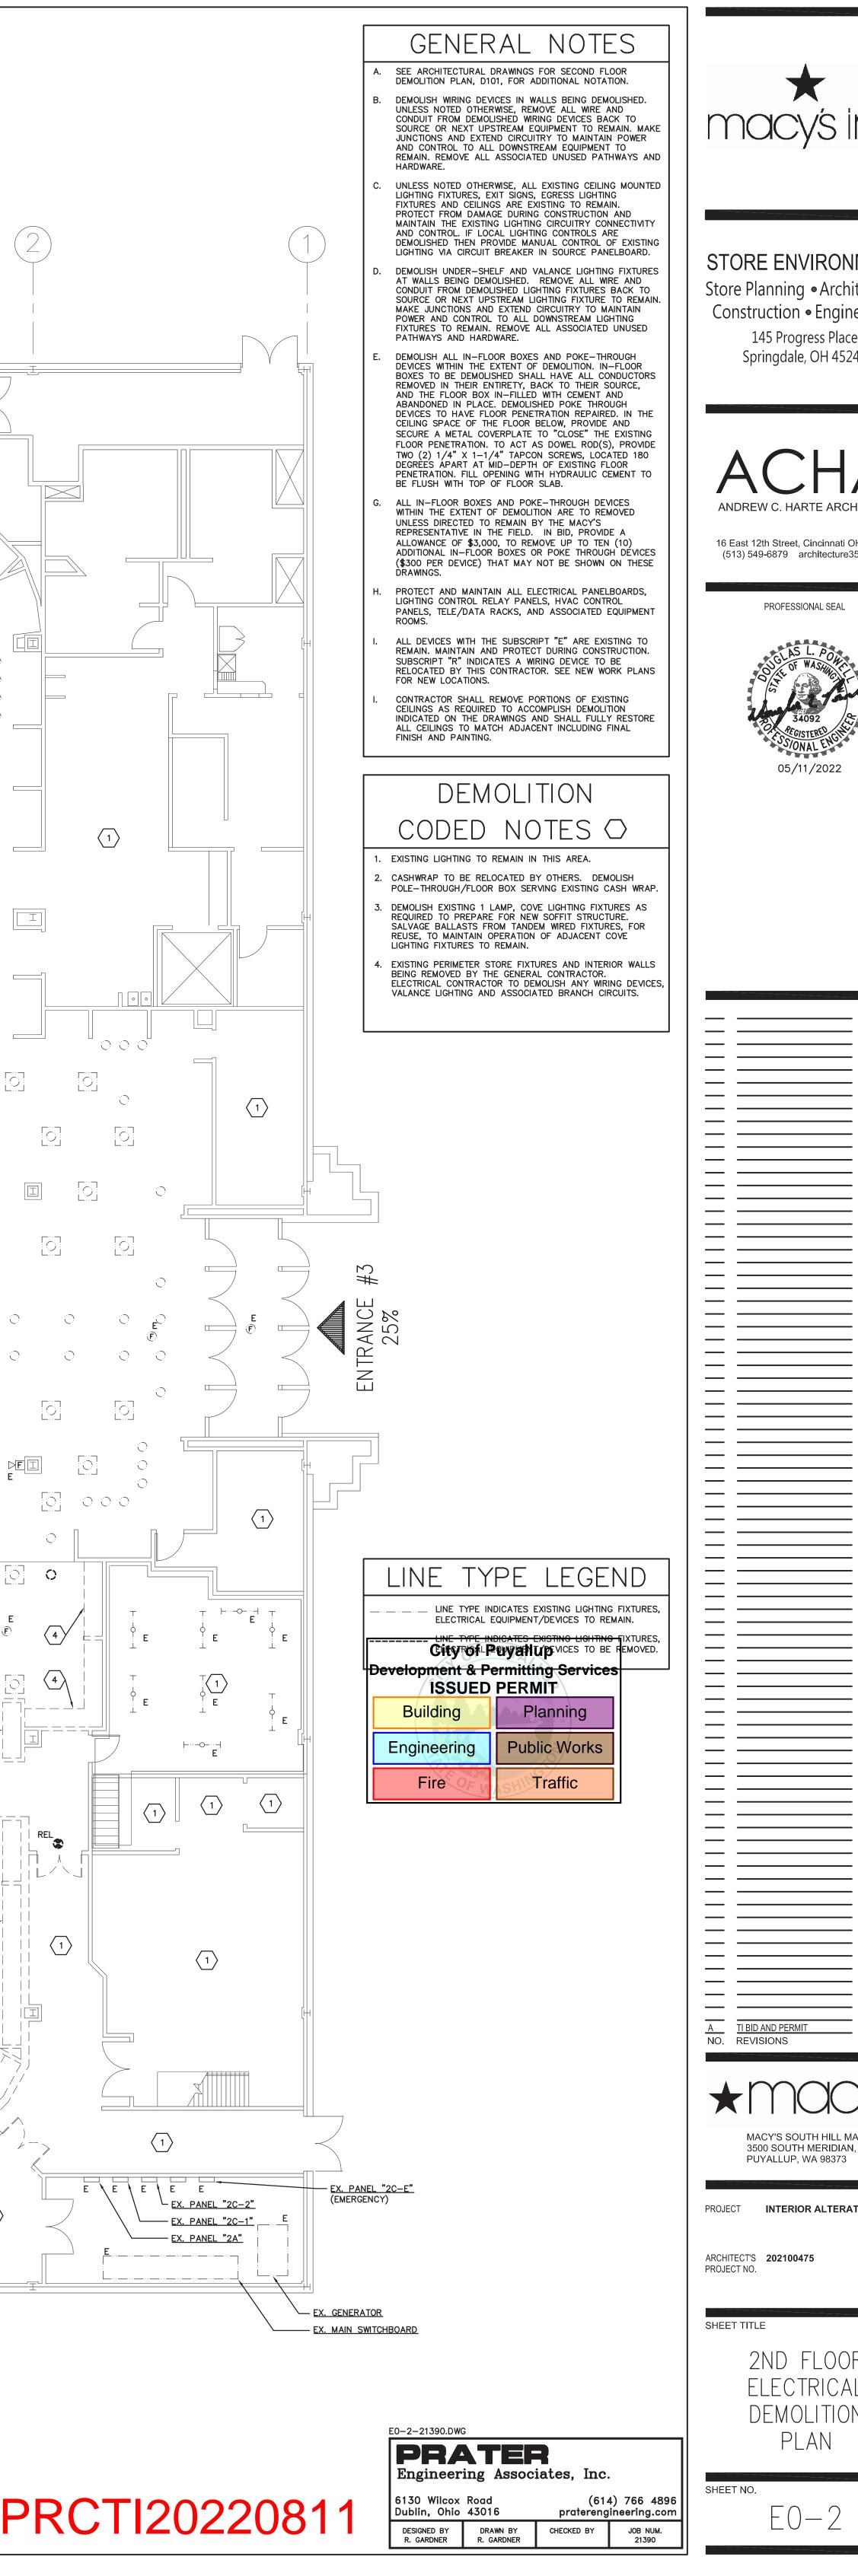

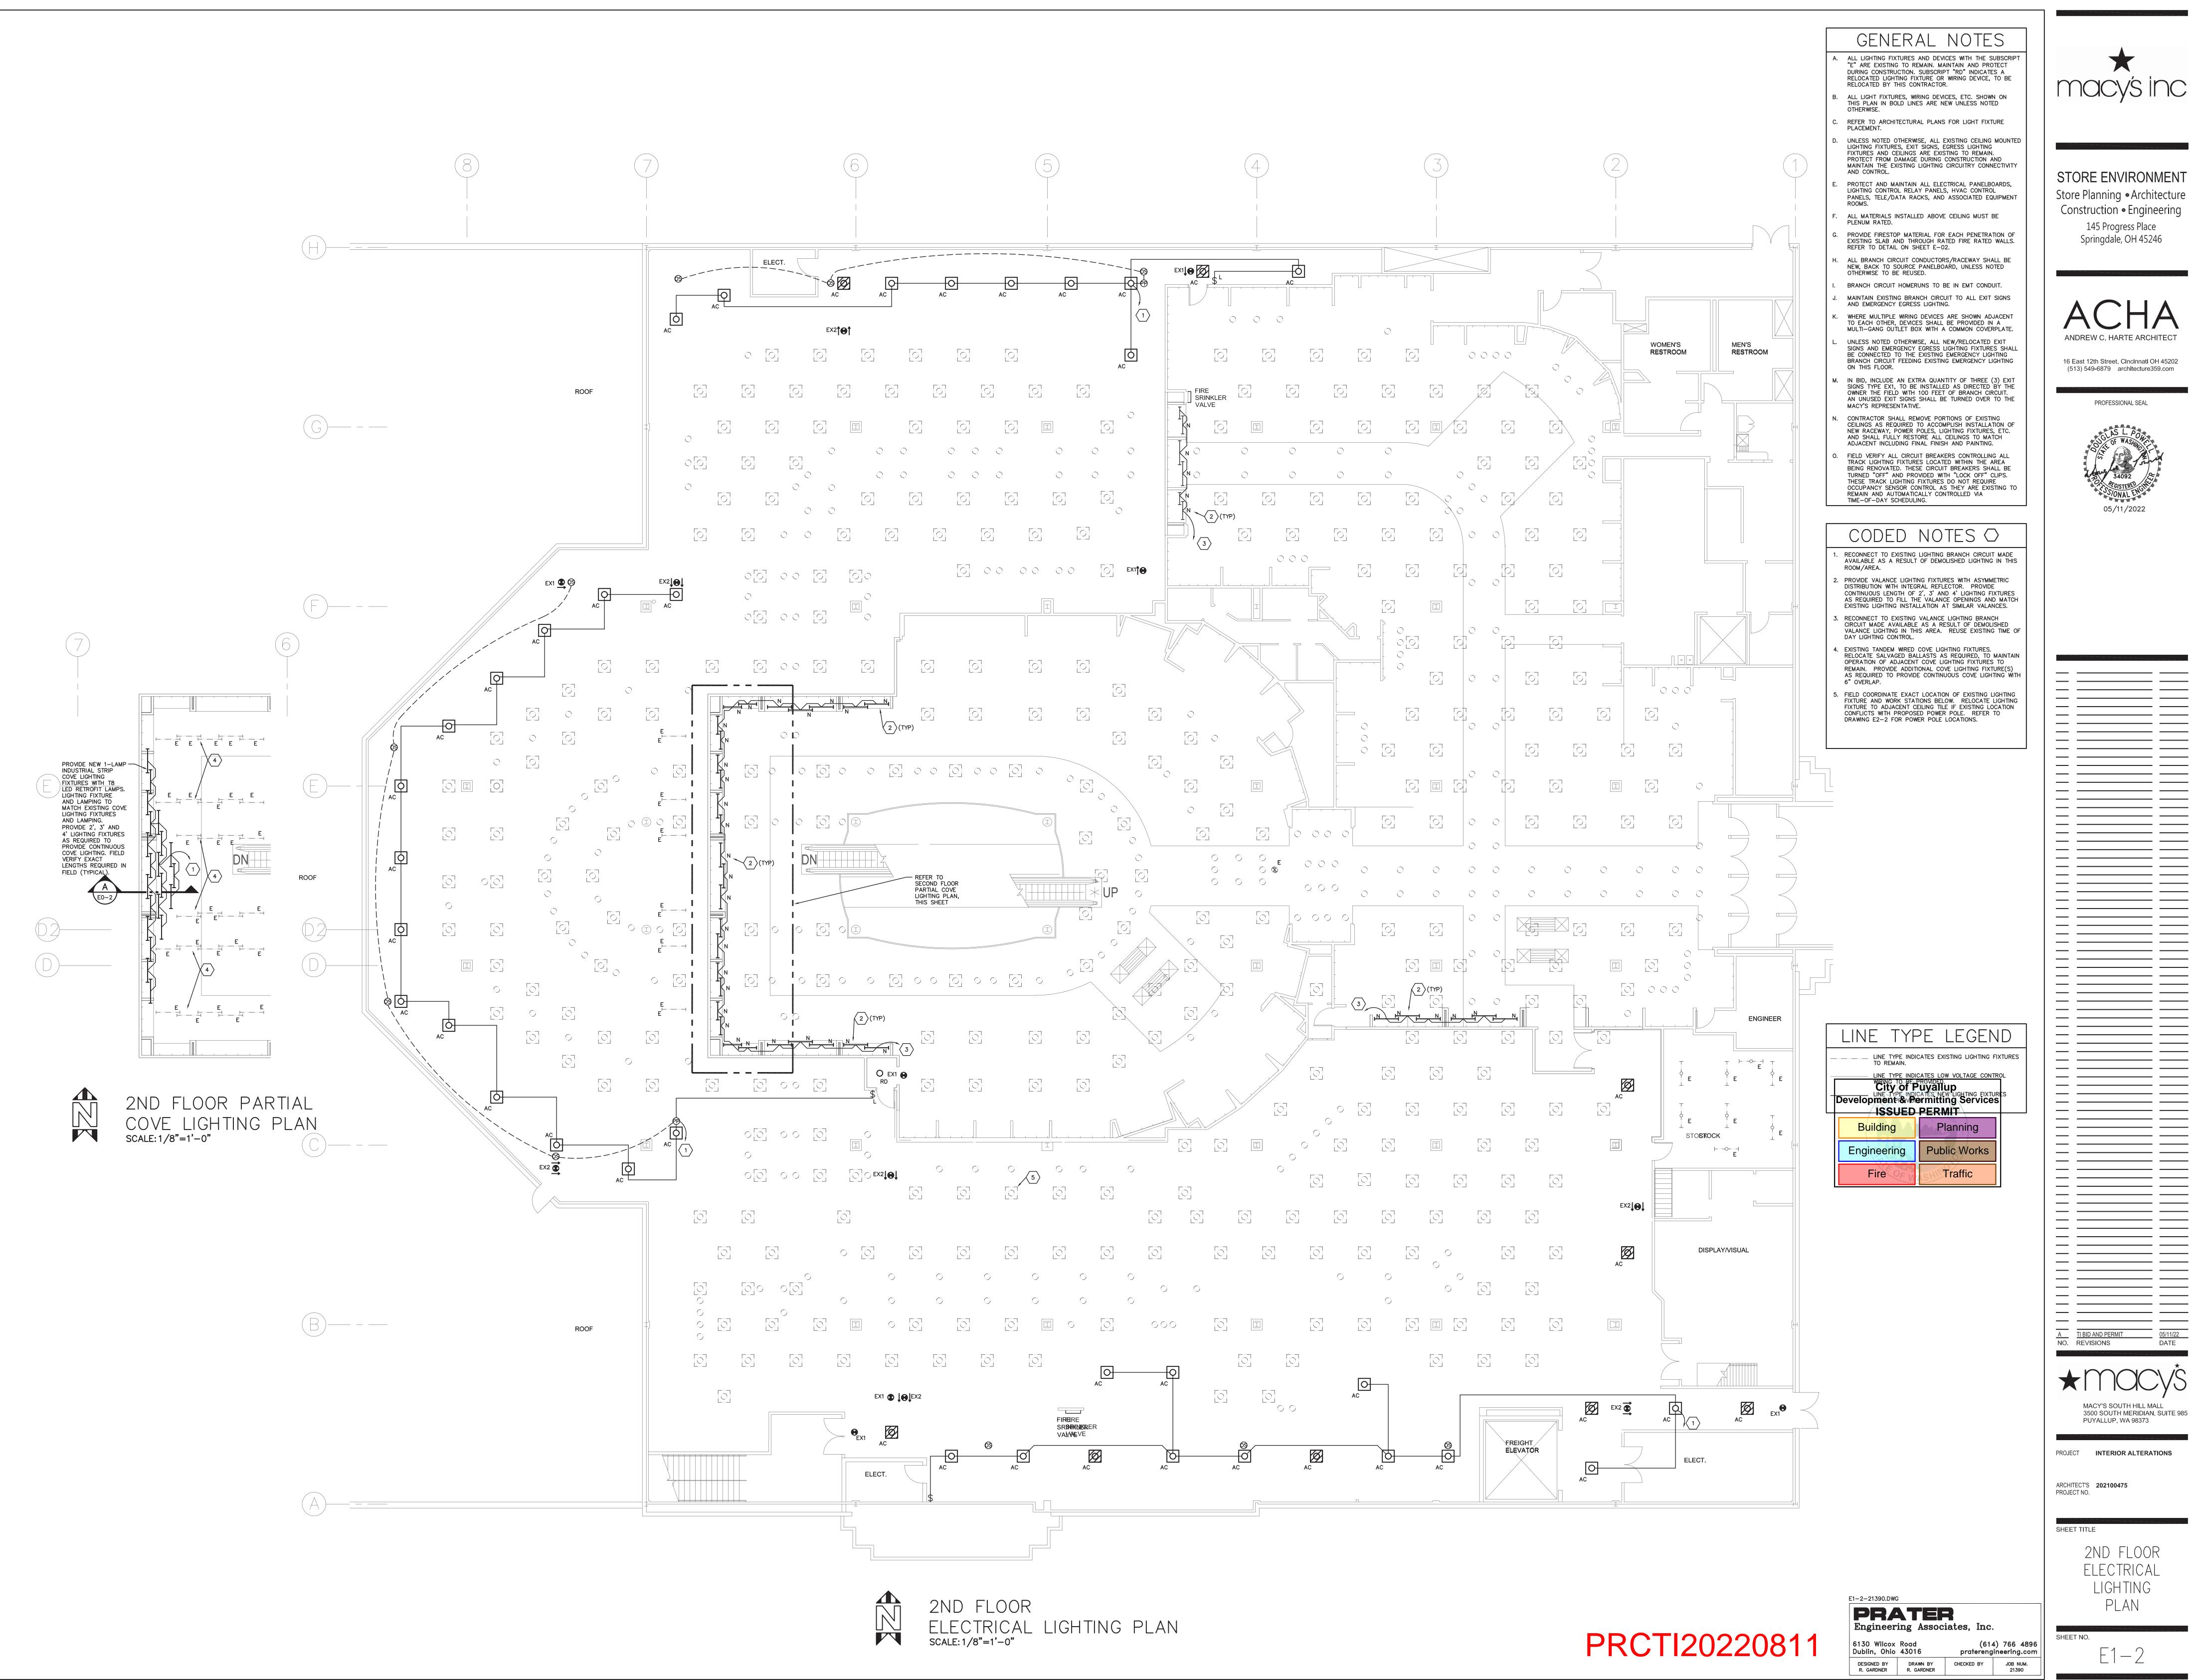

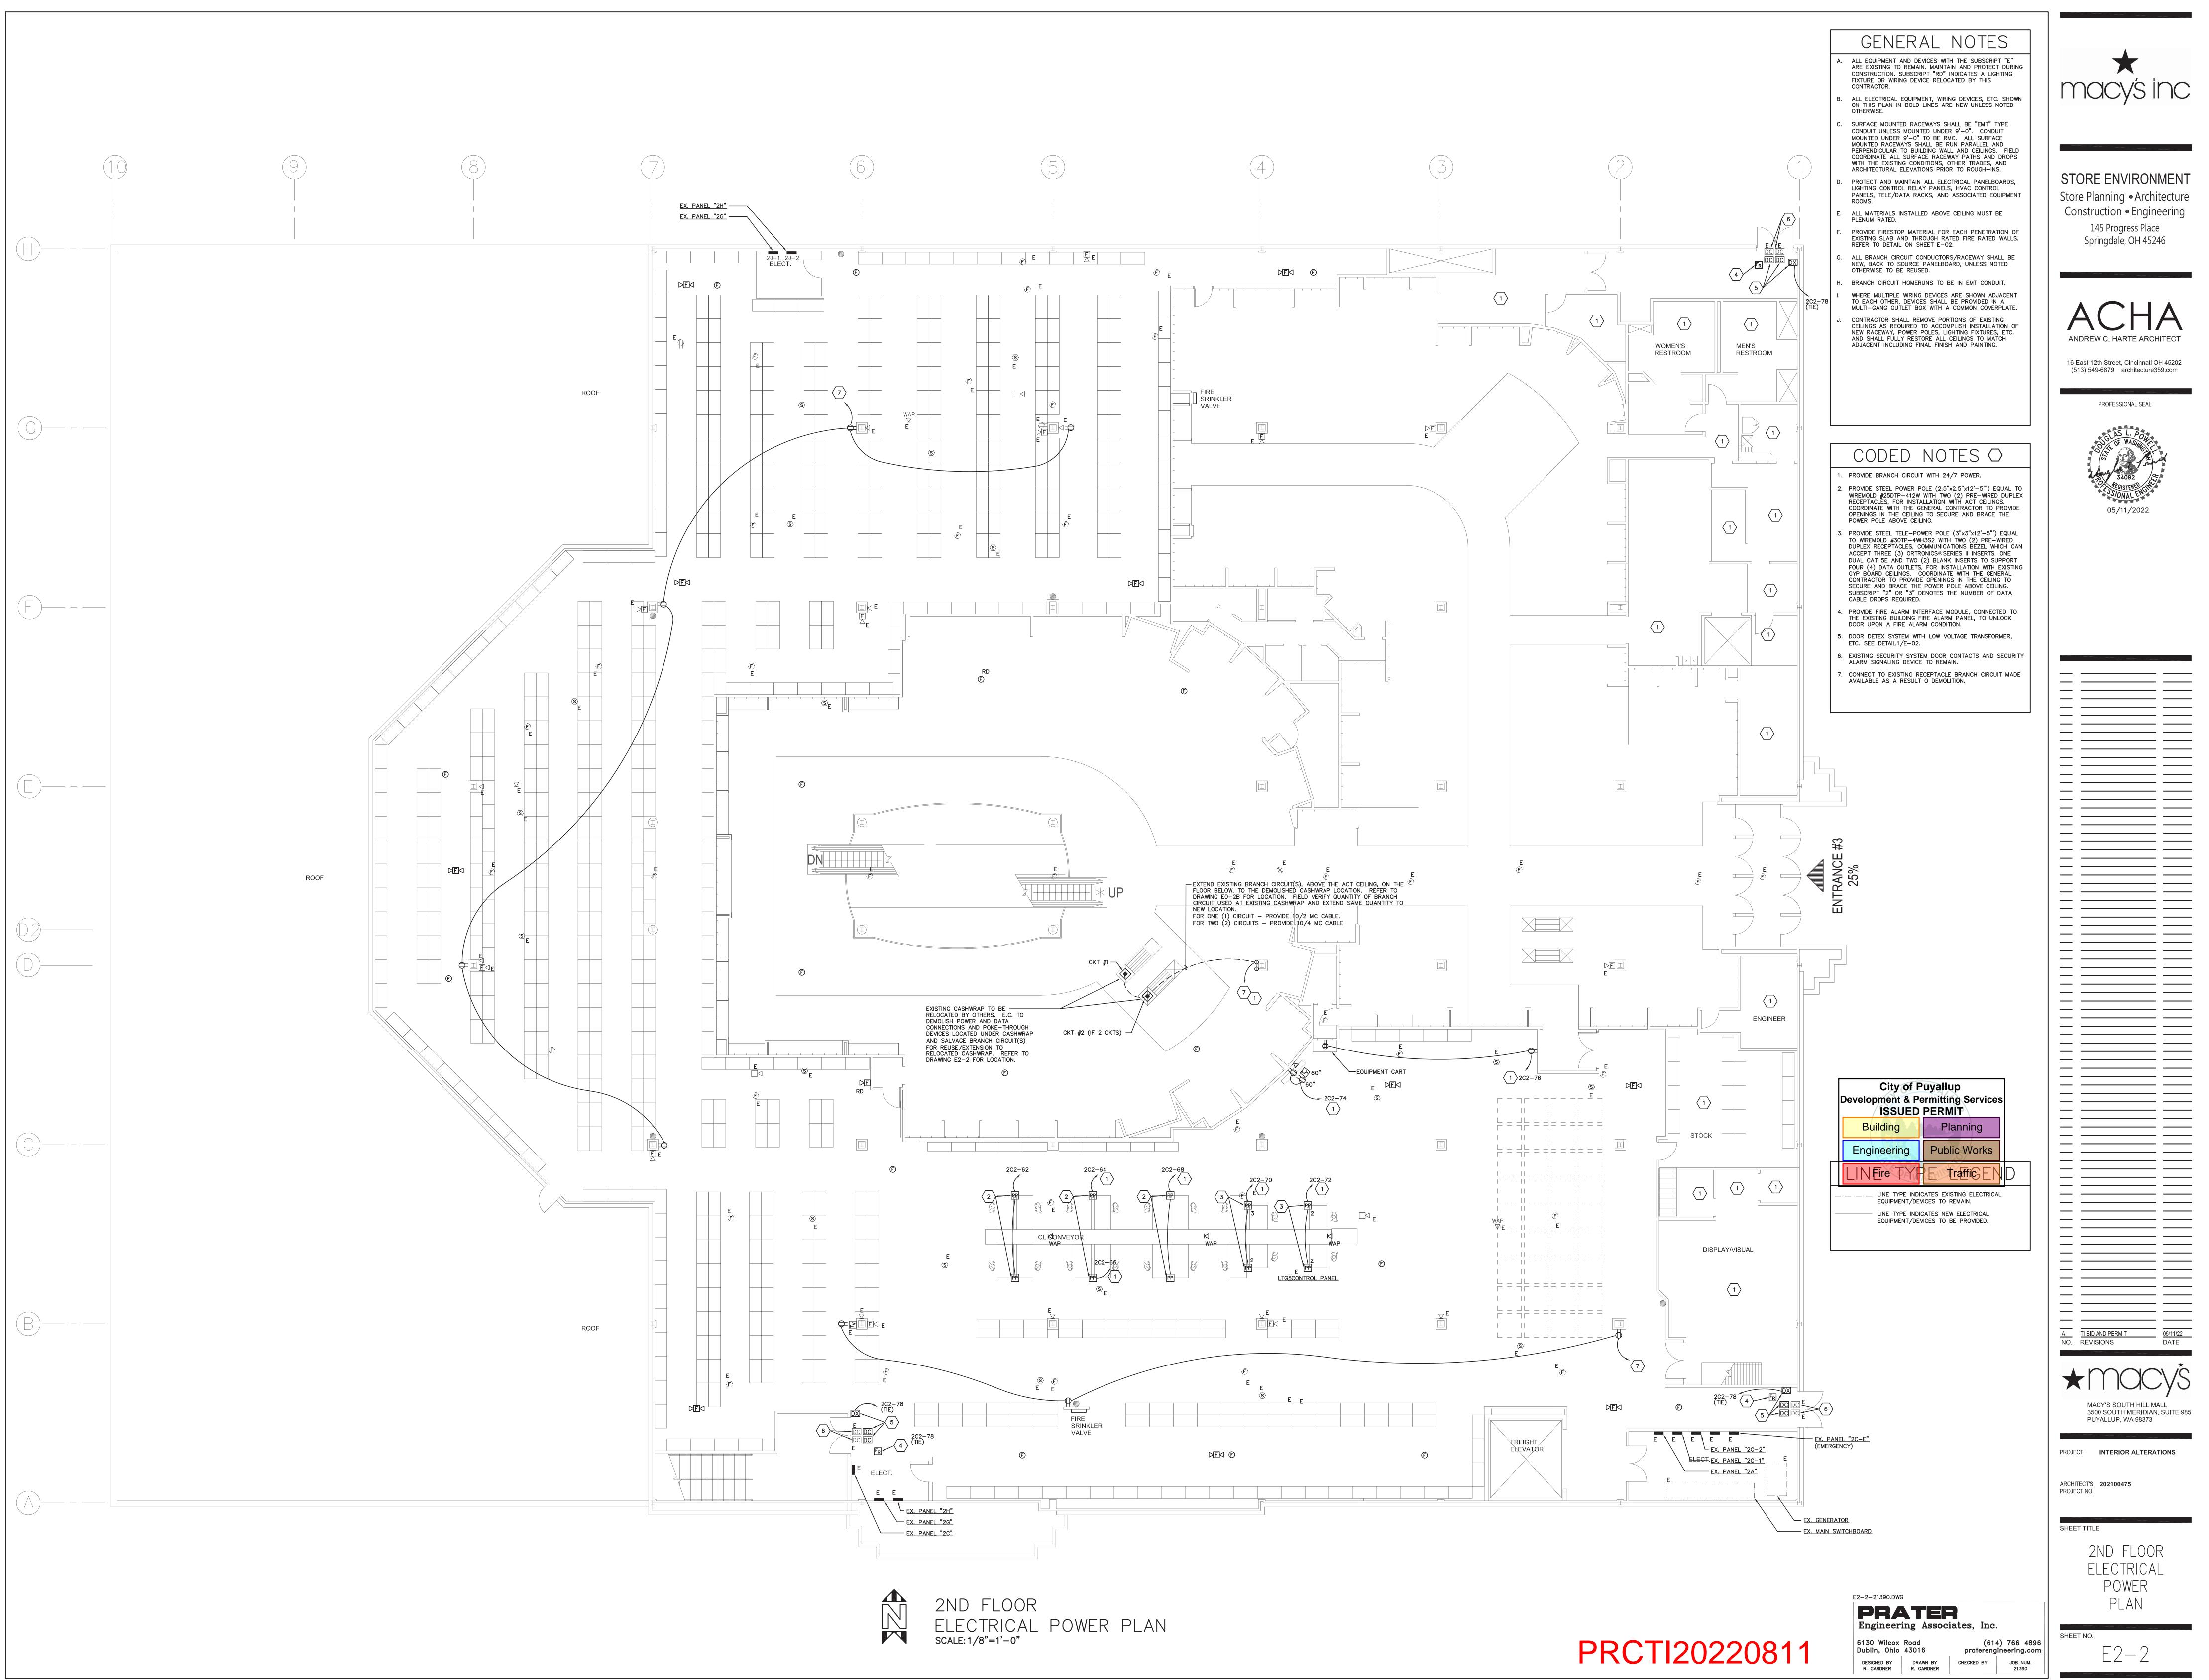

## LUMINAIRE SCHEDULE MACY'S PUY

TYPE	DESCRIPTION
EXISTING/RELOCATED	
O AC	2X2 VOLUMETRIC TROFFER
나 년 건 (N) STRIPLIGHTS	STRIP LIGHT LOCATED WITHIN NEW SOFFIT ARCHITECTURE

LIGHTING SCHEDULE NOTES SCHEDULE COMPILED BY 37VOLTS LIGHT STUDIO. REFER SPECIFICATION QUESTIONS TO LIGHTING DESIGNER. 1. AT TIME OF BIDDING, ANY SUBSTITUTIONS PROPOSED TO THE OWNER MUST DEMONSTRATE CONFORMANCE TO THE SPECIFICATION CHARACTERISTICS INCLUDING, BUT NOT LIMITED TO: SIZE, DESIGN AESTHETICS, MOUNTING CONDITION, NOMINAL AND DELIVERED LUMENS, CENTERBEAM CANDLEPOWER, COLOR TEMPERATURE, ACCESSORIES AS REQUIRED AND CONTROLS CAPABILITY REQUIRED BY APPLICATION. 2. ALL VOLTAGES TO BE REVIEWED AND CONFIRMED BY EE.

3. ALL FINISHES TO BE CONFIRMED BY ARCHITECT. 4. ALL LIGHTS ARE TO BE PROVIDED WITH REQUIRED HARDWARE FOR MOUNTING, AND ANY AUXILLIARY DRIVERS OR GEAR FOR A FULLY FUNCTIONAL LUMINAIRE READY FOR FINAL HOOK-UP BY CONTRACTOR. 5. IT IS THE CONTRACTOR'S RESPONSIBILITY TO COORDINATE LIGHTING WHICH MAY HAVE LONG LEAD TIMES WITH THEIR INSTALLATION SCHEDULE. ALL LIGHTS ARE TO BE BE PROMPTLY ORDERED UPON APPROVAL TO AVOID DELAYS, UNNECESSARY RE-SELECTIONS, ADDITIONAL FIXTURE COSTS AND/OR AIRFREIGHT CHARGES. 6. UNLESS OTHERWISE DETERMINED, ALL LIGHTING SUBMITTALS SHALL BE REFERRED TO THE LIGHTING DESIGNER AT 37VOLTS FOR REVIEW AND COMPLIANCE WITH THESE SPECIFICATIONS. 37VOLTS DOES NOT BEAR RESPONSIBILITY FOR SUBMITTALS APPROVED BY OTHER PARTIES WHICH DO NOT

CONFORM TO DESIGN AND PERFORMANCE CRITERIA AS PRESENTED IN THE SPECIFICATION DOCUMENTS.

### LUMINAIRE FIXTURE SCHEDULE - FIXTURES AND LAMPS PROVIDED BY EC LAMP DATA VOLTAGE QTY. TYPE LOG NO. CATALOG NO. REMARKS FIXTURE DESCRIPTION UNIVERSAL EXIT UNIVERSAL MTD, SINGLE FACE (EX1) OR DOUBLE FACE (EX2) WITH G—M6 WITH UNIT 120/277 LED GREEN STENCIL LETTERS AND WHITE THERMOPLASTIC HOUSING. ELC SHALL COORDINATE DIRECTIONAL ARROWS WITH THE LIGHTING PLANS, NON-SALES AREA, MTD 12" ABOVE DOOR OR SUSPENDED 12' AFF. FIXTURE IS SINGLE FACE WITH EXTRA FACE PLATE FOR FIELD CONVERSION TO DOUBLE FACE.


COMCHECK			ISHED 3Y			
WATT	CIRCUIT WATT	OWNER	EC	SYMBOL	MFG	CATALO
1	1		X	₩ EX1 ₩ EX2	LITHONIA	EXRG
				NON-SALES, BACK-OF- HOUSE		

SCHEDULE CONTENTS ARE NOT TO BE MODIFIED WITHOUT PRIOR WRITTEN CONSENT OF MACY'S SPACE LIGHTING.


JY	ALLUP – FIXTURES	S AND LAMPS F	URNISHED	BY MA	CY'S, INSTALLEI	D BY EC					
	<u>LUMINAIRE_MANUFACTURER</u> PART-NUMBER	LUMINAIRE CONTACT	MOUNTING/ CLG TYPE	LAMP QTY	SOURCE OR LAMP TYPE	LAMP CONTACT	LUMENS	BEAM SPREAD	FINISH	COMMENTS	BALLAST/ DRIVE
	<u>ACUITY/LITHONIA</u> 2VTL2-40L-ADP-EZ1-LP830	MELINDA BRUEGGEMANN ACUITY, 317-650-3203 Melinda.Brueggemann@ AcuityBrands.com	RECESSED ACT	N/A	INTEGRAL LED, 3000K 80+ CRI	N/A	NOMINAL 3919	DIFFUSED ACRYLIC	N/A	WHITE	INTEGRAL 0-10V
	REFERENCE ONLY; LITHONIA: #S1 SERIES WITH ASYMMETRIC REFLECTOR	MELINDA BRUEGGEMANN ACUITY, 317-650-3203 Melinda.Brueggemann@ AcuityBrands.com	SURFACE AT PERIMETER ARCHITECTURE	1	LINEAR T8 FOR LAMPING MATCH EXISTING VERIFY P-NUM IN FIELD	E. SAM JONES LIGHTING (615) 254–5555	NOMINAL 700LM PER FT	N/A	WHITE	PROVIDE 2', 3' AND 4' LENGTHS AS SHOWN ON THE DRAWINGS TO PROVIDE VALANCE LIGHTING	QTP1x32T8/UNV ISN-SC

	GEN	NERA	LLI	GΗT	ING	ΝΟΤ	ΕS
GENERA	L SPECI	FICATI	0 N S				
,	ALL FURNISH A NG SCHEDULE.	ll luminaire	S AND LAM	PS INSTALLE	D IN THE CE	ILING UNLES	S OTHERWISE I
2.) ALL SPECI	FIED EQUIPMENT S. SUBSTITUTIO				•		
3.) COMPATAB	RE PROVIDIED FO	RICAL SYSTEM	MITH THE	SPECIFIED L		URES SHALL	BE THE RESP
4.) PRIOR TO	ECTRICAL ENGIN	OF LIGHT FIXT	URES ELECT	RICAL CONT			
FIXTURES I	RICAL SYSTEM DO NOT MEET V	OLTAGE REQ	UIREMENTS.				
	IAIRE OR LAMP L CONTRACTOR						
•	FIXTURE WIRING R SUSPENDED L						

DOOR CONTACTS FLUSH MOUNTED, FURNISHED BY GC AND INSTALLED BY E.C. SEE 2/E0-1, TYPICAL
120V EMERGENCY
TRANSFORMER 10'AFF, 110V INPUT TO TRANSFORMER
LOW VOLTAGE
SECURITY EQUIP. FURNISHED BY OWNER, INSTALLED BY OWNER.
KEY SWITCH CONTROLLER FLUSH MTD
NOTE: 1. E.C. SHALL PROVIDE A COMPLETE AND OF 120 VOLT DETEX SYSTEM. E.C. SHALL COO WITH DOOR INSTALLATION AND ACTUAL EQ FURNISHED – I.E. DETEX, VON DUPRIN, E SHALL PROVIDE CONDUIT, AND J-BOXES F MANUFACTURER'S REQUIREMENTS.
1 DOOR - DETEX/VON DUPRIN NO SCALE

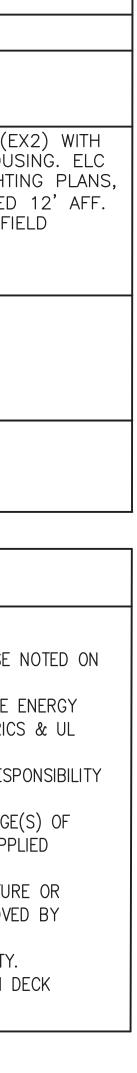


SYSTEM	MATERIAL	REMARKS
	POWER RACEWAYS	I
HOMERUNS AND IN COLUMNS	EMT	_
BELOW SLAB / IN GRADE	PVC SCHEDULE 40	_
LIGHTING/RECEPTACLE WHIPS/MOTORS	METAL CLAD CABLE OR EMT	_
		_
	LOW VOLTAGE RACEWAYS	
FIRE ALARM CABLING	MC	-
VOICE/DATA/SECURITY/HVAC/CATV	J-HOOKS	1
REMARKS:		
1. PLENUM RATED CABLE SHALL BE USE	D IN CONCEALED AIR HANDLING SPACES.	

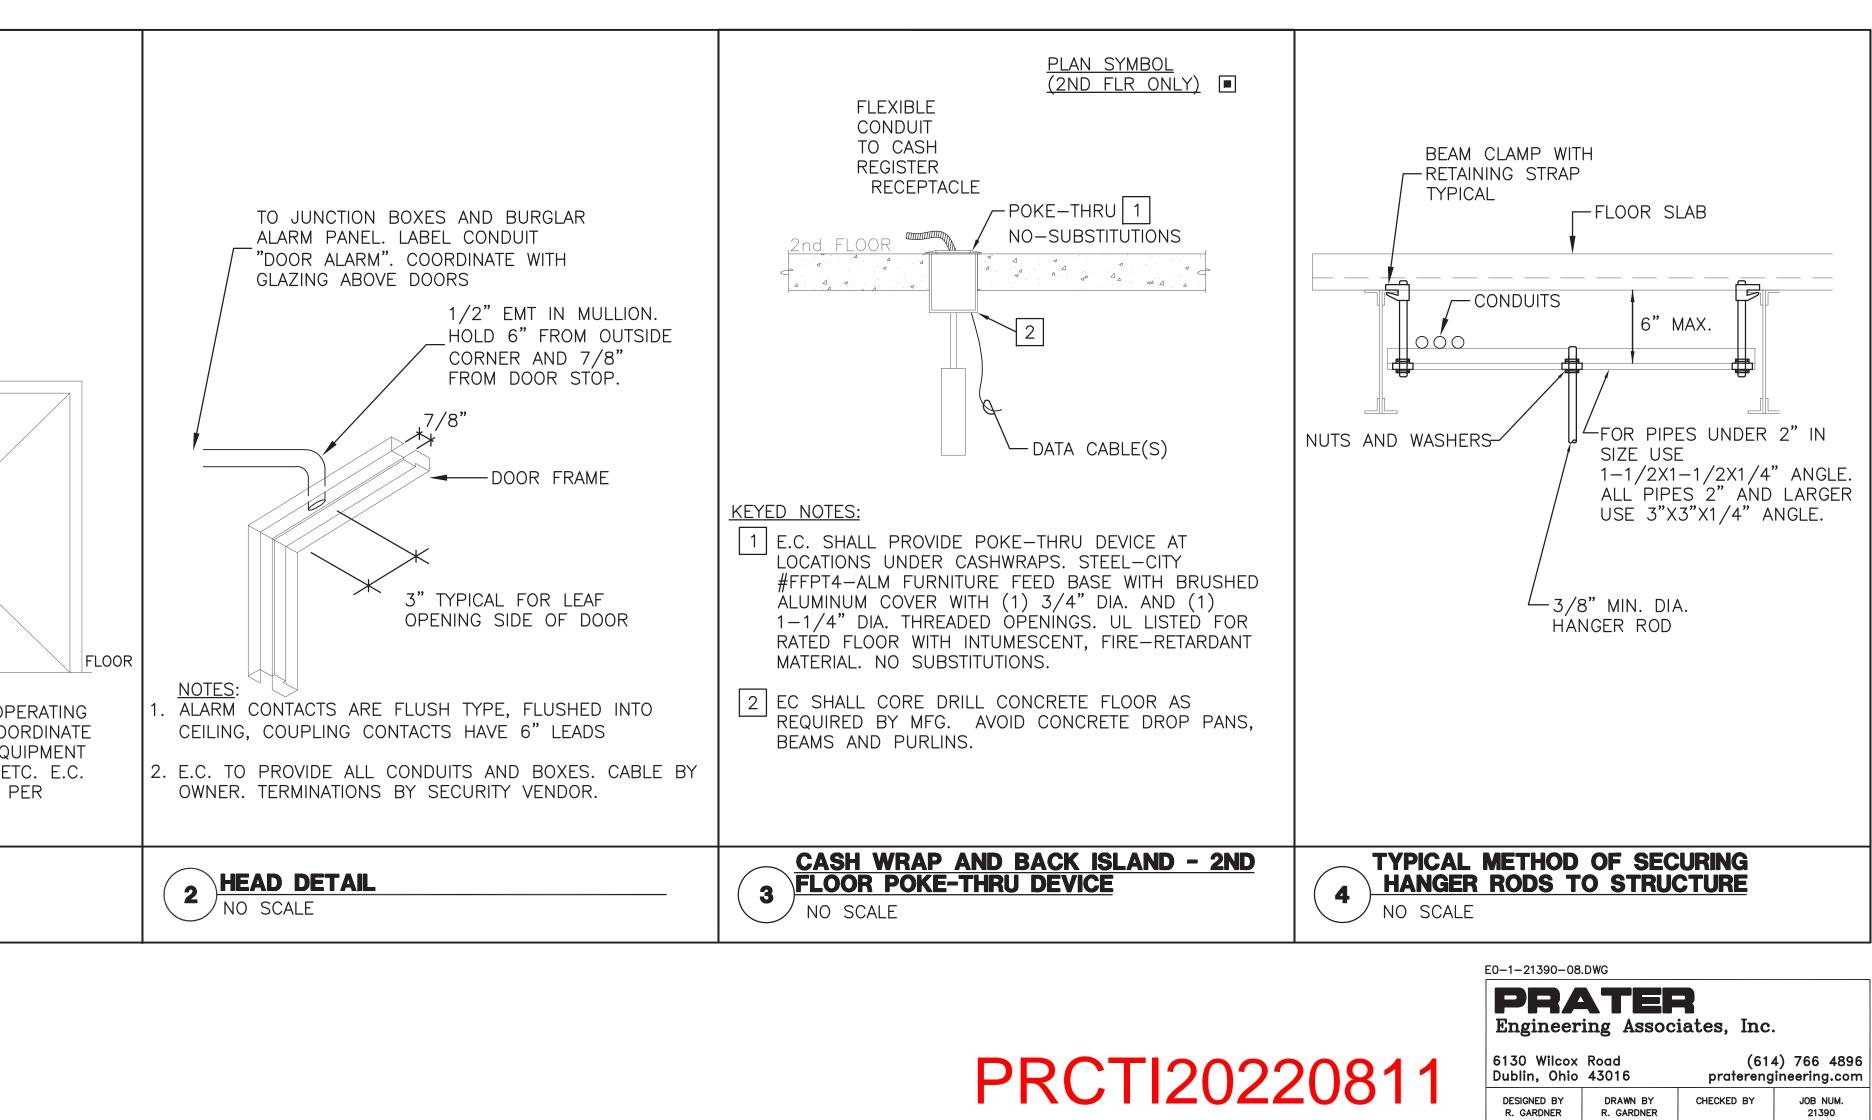

AST/ DRIVER	INPUT WATTS	VOLTAGE	EQUAL ALTERNATES FOR BIDDING
NTEGRAL 0–10V	41.3	MULT	METALUX RAB SOLAIS
32T8/UNV SN-SC	ALLOW 28W PER 4FT TUBE MAXIMUM	MULT	N/A

City of Puyallup Development & Permitting Services ISSUED PERMIT				
Building	Planning			
Engineering	Public Works			
Fire	Traffic			

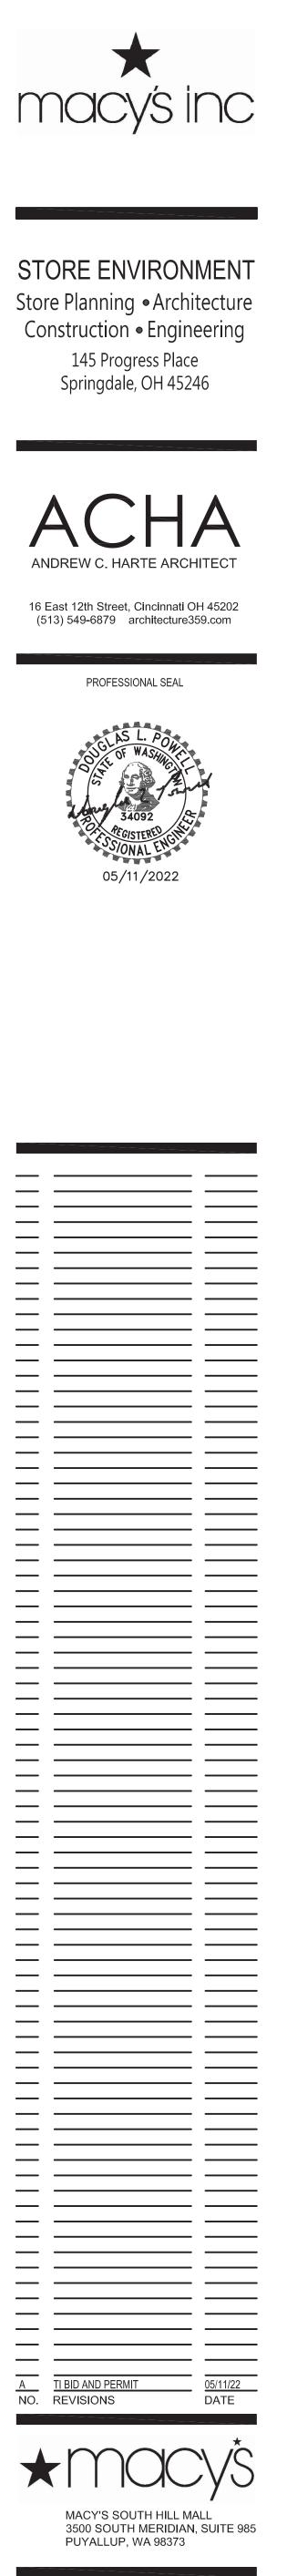

PROJECT INTERIOR ALTERATIONS

ELECTRICAL


SCHEDULES

E - 01

ARCHITECT'S 202100475 PROJECT NO.

SHEET TITLE


SHEET NO.

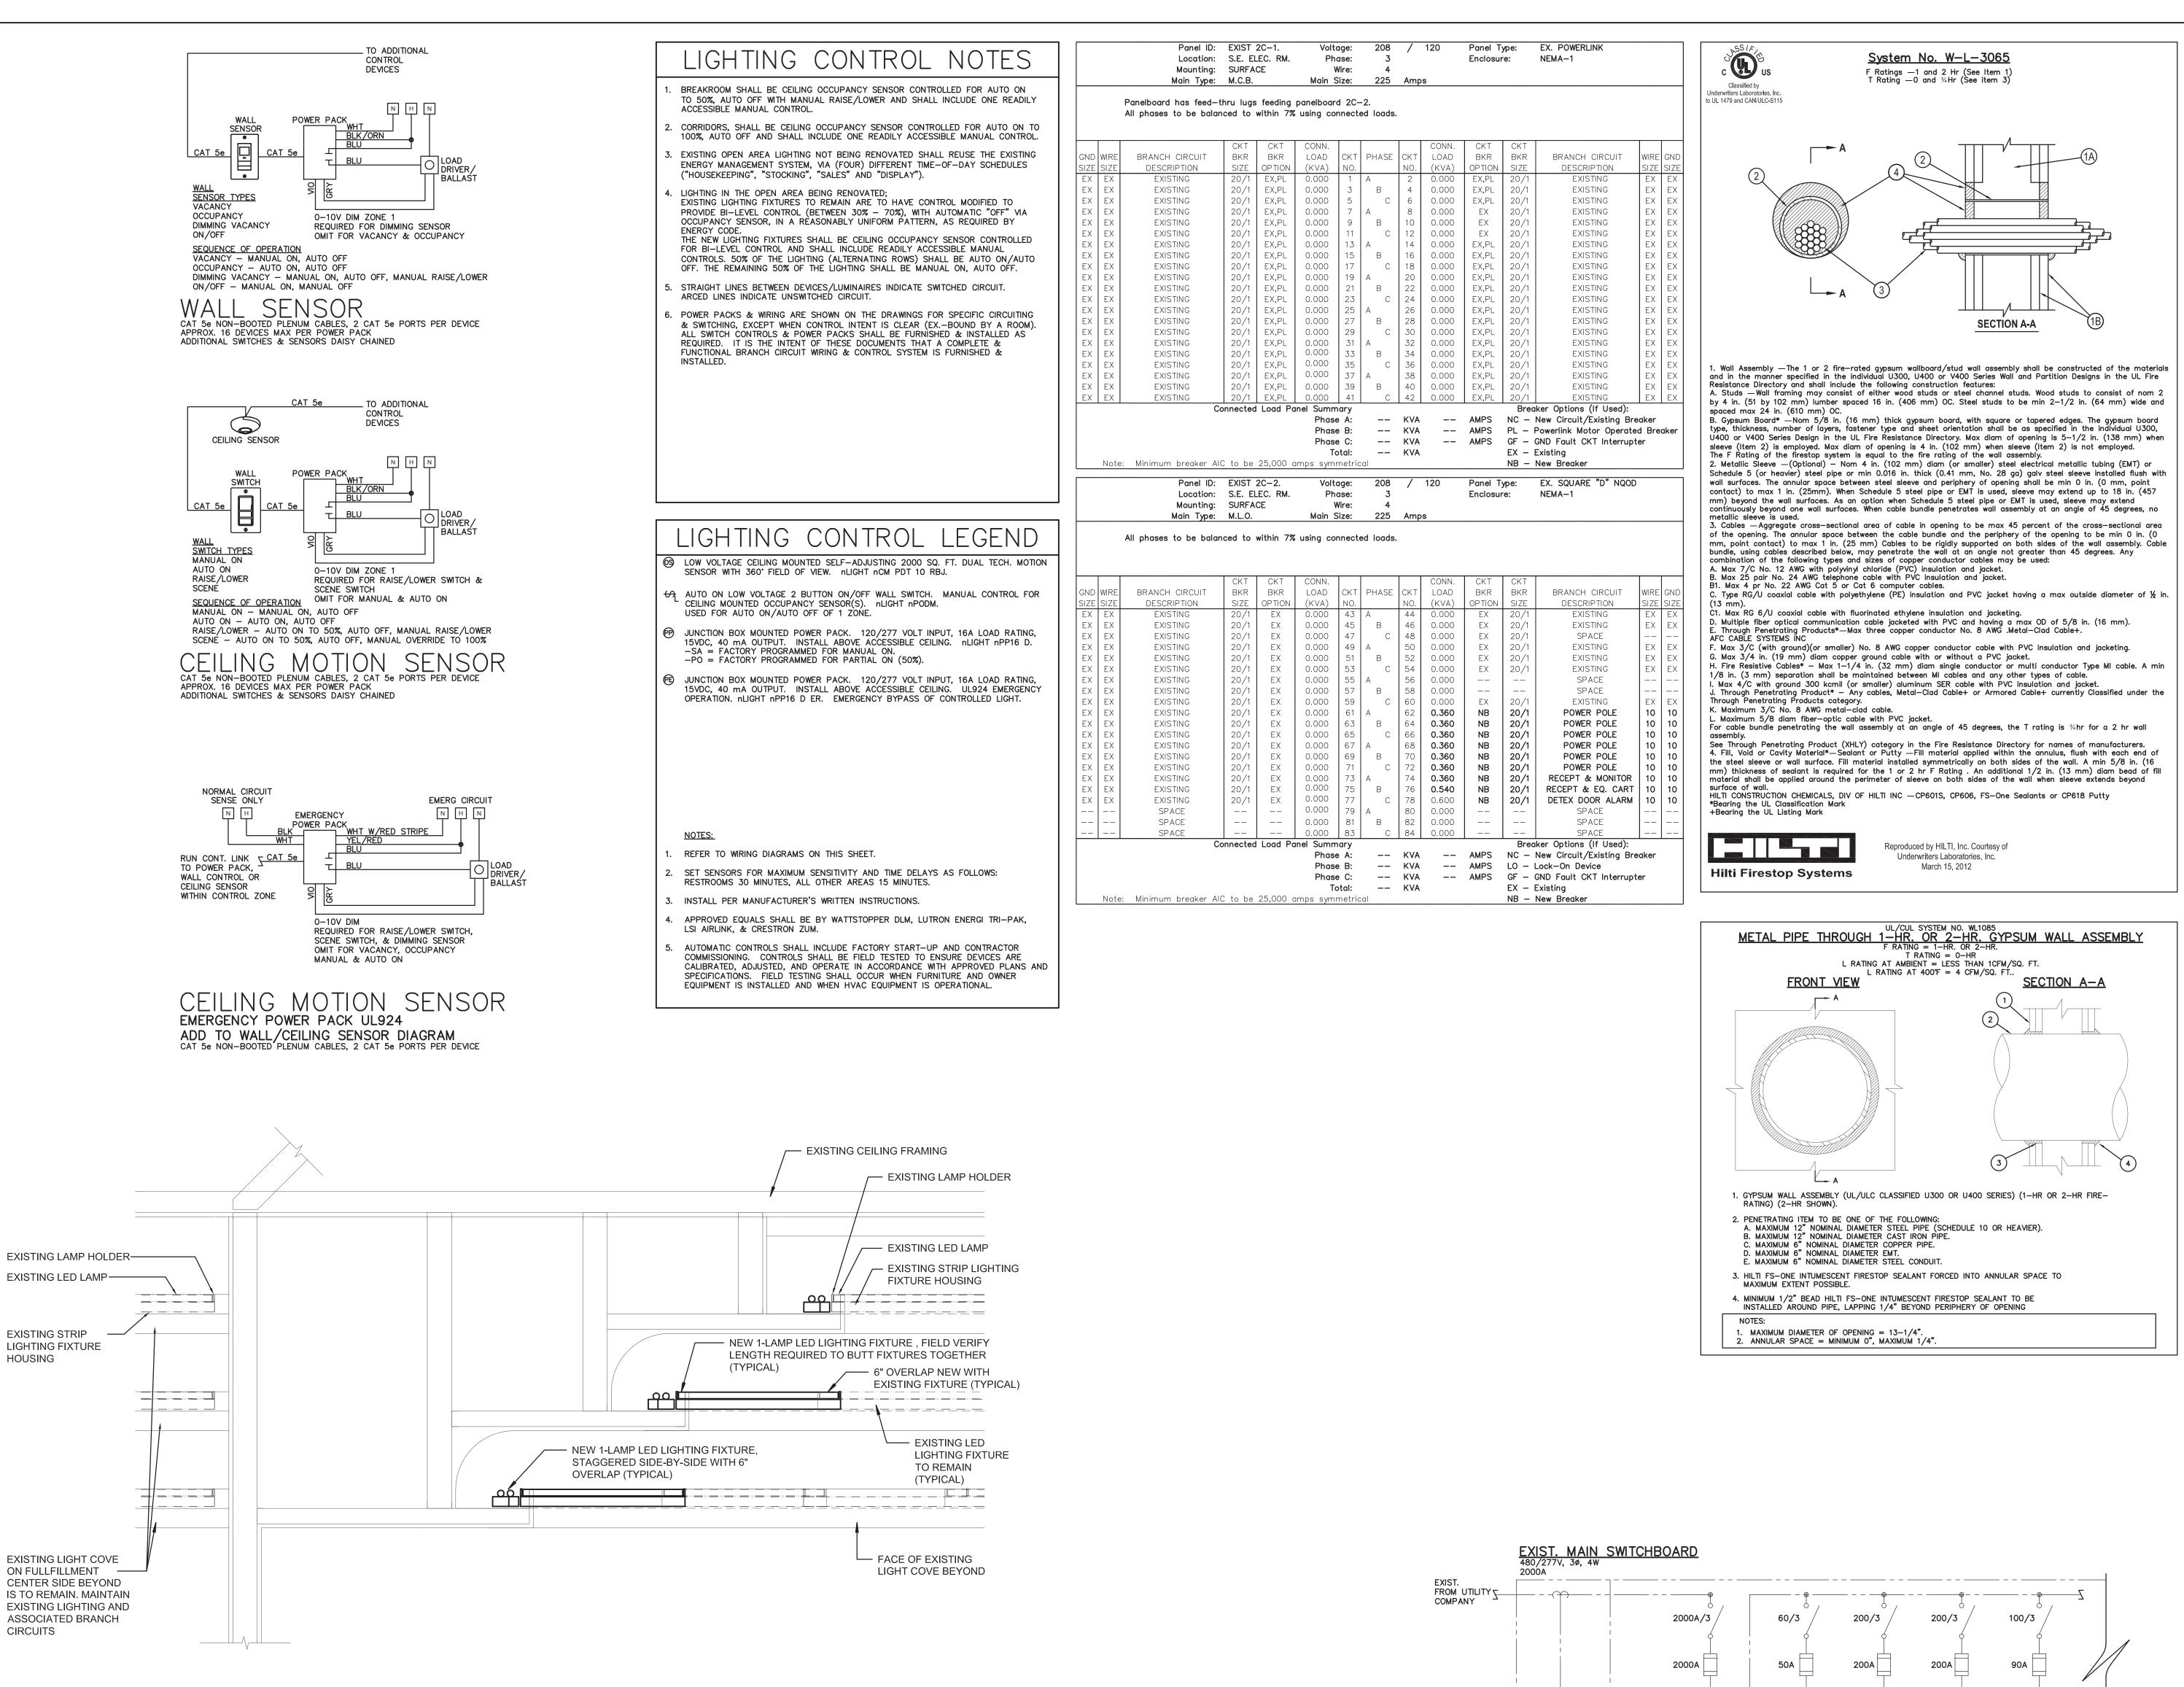

SECTION "A" COVE LIGHTING SCALE: NO SCALE

HOUSING


CIRCUITS

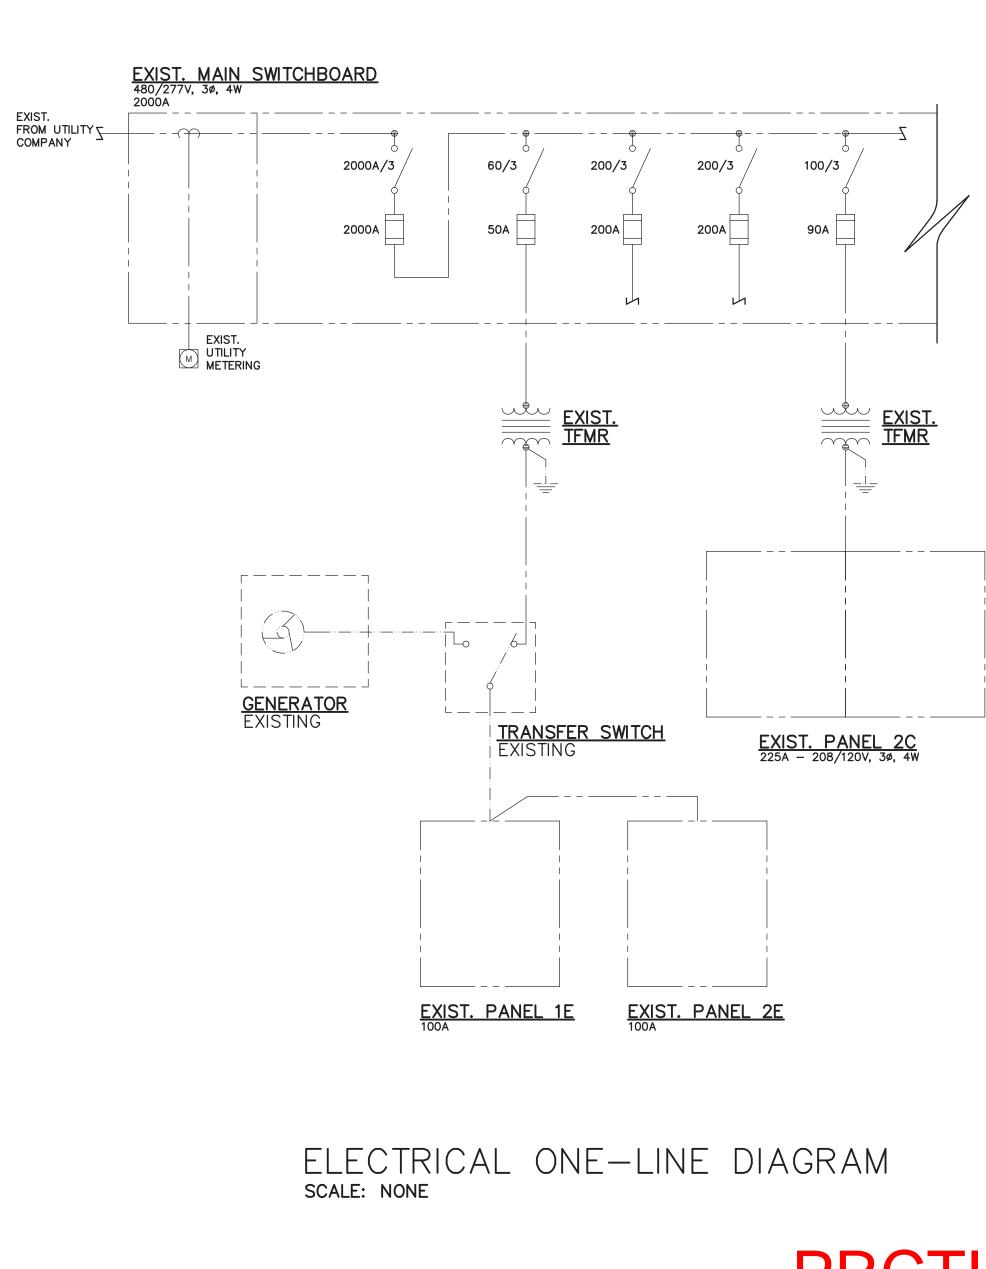

EL	ECTRICAL A	BBREVI	ATIONS		
AWG	AMERICAN WIRE GAUGE	GRD (	GROUND		
A	AMPERE		ECHANICAL CONTROACTOR		
AFF	ABOVE FINISHED FLOOR	LTG L	IGHTING		
CLG	CEILING MECH		/ECHANICAL		
С	CONDUIT	P.C. F	PLUMBING CONTRACTOR		
E.C./EC/ELC	ELECTRICAL CONTRACTOR				
E	EXISTING TO REMAIN	RECEPTACLE			
FACP	FIRE ALARM CONTROL PANEL	WP V	VEATHERPROOF		
FIX G.C.	FIXTURE GENERAL CONTRACTOR				
	ELECTRICA	AL LEGE	ND		
SYMBOL	DESCRIPTION		MOUNTING HGT. TO CENTER UNLESS OTHERWISE NOTED		
	EXISTING CEILING OR WALL MOUNTE	D LIGHTING FIXTURE TO	REMAIN		
	CEILING OR WALL MOUNTED LIGHTIN "R2", "W2"; SEE LIGHTING FIXTURE				
€ € € €	EXIT SIGN FIXTURE (WITH DIRECTION SHOWN) (TYPE AND MOUNTING AS I LIGHTING FIXTURE SCHEDULE)	AL ARROWS AS NOTED: SEE	90"		
±€	EXIT SIGN WITH INTEGRAL EMERGEN WALL MOUNTED / CEILING	CY LIGHTING HEAD	AS REQUIRED		
	LIGHTING FIXTURE CONNECTED TO E	MERGENCY POWER	SEE DRAWINGS		
\$2; 3; 4; K; P	SPECIAL SWITCH: 2-WAY; 3-WAY; OPERATED; SWITCH WITH PILOT LIGH	4-WAY; KEY IT	42 <b>"</b>		
<b>©</b> \$ os	OCCUPANCY SENSOR; CEILING / WA		TAGE 42"		
	DUPLEX RECEPTACLE; 3 WIRE GROU	ND TYPE	18"		
۲	DUPLEX RECEPTACLE; FLOOR MOUN	TED			
⇒ <sup>WP</sup>	DUPLEX RECEPTACLE WEATHERPROC	F	18"		
⊐⊖ <sup>GF</sup>	DUPLEX RECEPACLE W/ GROUND FA	AULT INTERRUPTER	18"		
€	SPECIAL RECEPTACLE - SEE DRAW	NGS	18"		
-	DOUBLE DUPLEX RECEPTACLE		18"		
- <del>-</del> 0	SINGLE RECEPTACLE		18" SEE DRAWINGS		
B	JUNCTION BOX; WALL MOUNTED JUNCTION BOX WITH BLANK COVER		SEE DRAWINGS		
Ū ∇	COMBINATION TELEPHONE / DATA C	DUTLET	18"		
$\nabla^{AP}$	ACCESS POINT FOR CCTV CAMERAS		AS REQUIRED		
$\nabla^{WAP}$	WIRELESS ACCESS POINT		AS REQUIRED		
S-f S	NOTIFICATION ALARM		AS REQUIRED		
	HORN		AS REQUIRED		
	ELECTRICAL PANEL - SURFACE MO	JNT, FLUSH MOUNT			
4	SAFETY DISCONNECT SWITCH		AS REQUIRED		
4	COMBINATION MOTOR STARTER		AS REQUIRED		
	MOTOR - 1 PHASE		AS REQUIRED		
PP	POWER POLE		AS REQUIRED		
TV	TELEVISION OUTLET	AS REQUIRED			
	PUSH BUTTON 42"				
Ē	SMOKE DETECTOR - CEILING MOUNT				
® A	HEAT DETECTOR DETECTOR - CEILIN SMOKE DETECTOR - DUCT MOUNTED		SEE DRAWINGS		
RT	DUCT MOUNTED SMOKE DETECTOR F		SEE DRAWINGS		
FR	FIRE ALARM ADDRESSABLE INTERFA		42"		
Ts	FIRE ALARM ADDRESSABLE INTERFA	76			
Fs	FIRE ALARM SPRINKLER SYSTEM FLOW SWITCH				
Ps	FIRE ALARM SPRINKLER SYSTEM PR				
Ē	FIRE ALARM PULL STATION		42"		
Ē	FIRE ALARM SIGNAL - HORN/STROE	BE, WALL MOUNTED	80"		
	FIRE ALARM SIGNAL - HORN/STROP	ON CEILING			
	FIRE ALARM SIGNAL - STROBE, WA		80"		
- CED-	FIRE ALARM SIGNAL - STROBE, CEI		80"		
3-® C⊲	FIRE ALARM SIGNAL - SPRINKLER F	LUW ALARM BELL	AS REQUIRED		
	DETEX ACCESS CONTROL SYSTEM		AS REQUIRED		

City of Puyallup Development & Permitting Services ISSUED PERMIT				
Building	Planning			
Engineering	Public Works			
Fire OF W	Traffic			

-21390-08	.DWG			
	TEF	2		
ngineer	ing Assoc	iates, Inc.		1
30 Wilcox blin, Ohio		(614 pratereng	4) 766 4896 ineering.com	
SIGNED BY GARDNER	DRAWN BY R. GARDNER	CHECKED BY	JOB NUM. 21390	Ι.

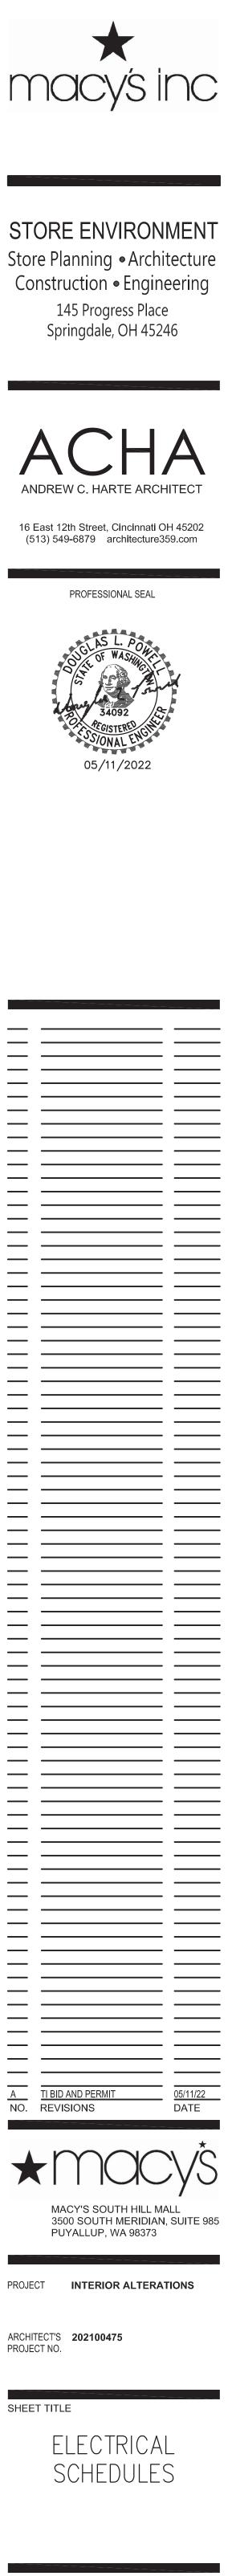

E - 02

