





THE APPROVED CONSTRUCTION
PLANS AND ALL ENGINEERING
MUST BE POSTED ON THE JOB AT
ALL INSPECTIONS IN A VISIBLE AND
READILY ACCESSIBLE LOCATION.

Approval of submitted plans is not an
approval of omissions or oversight by this
office or noncompliance with any
applicable regulations of local government.
The contractor is responsible for making
sure that the building complies with all
applicable building codes and regulations of
the local government.

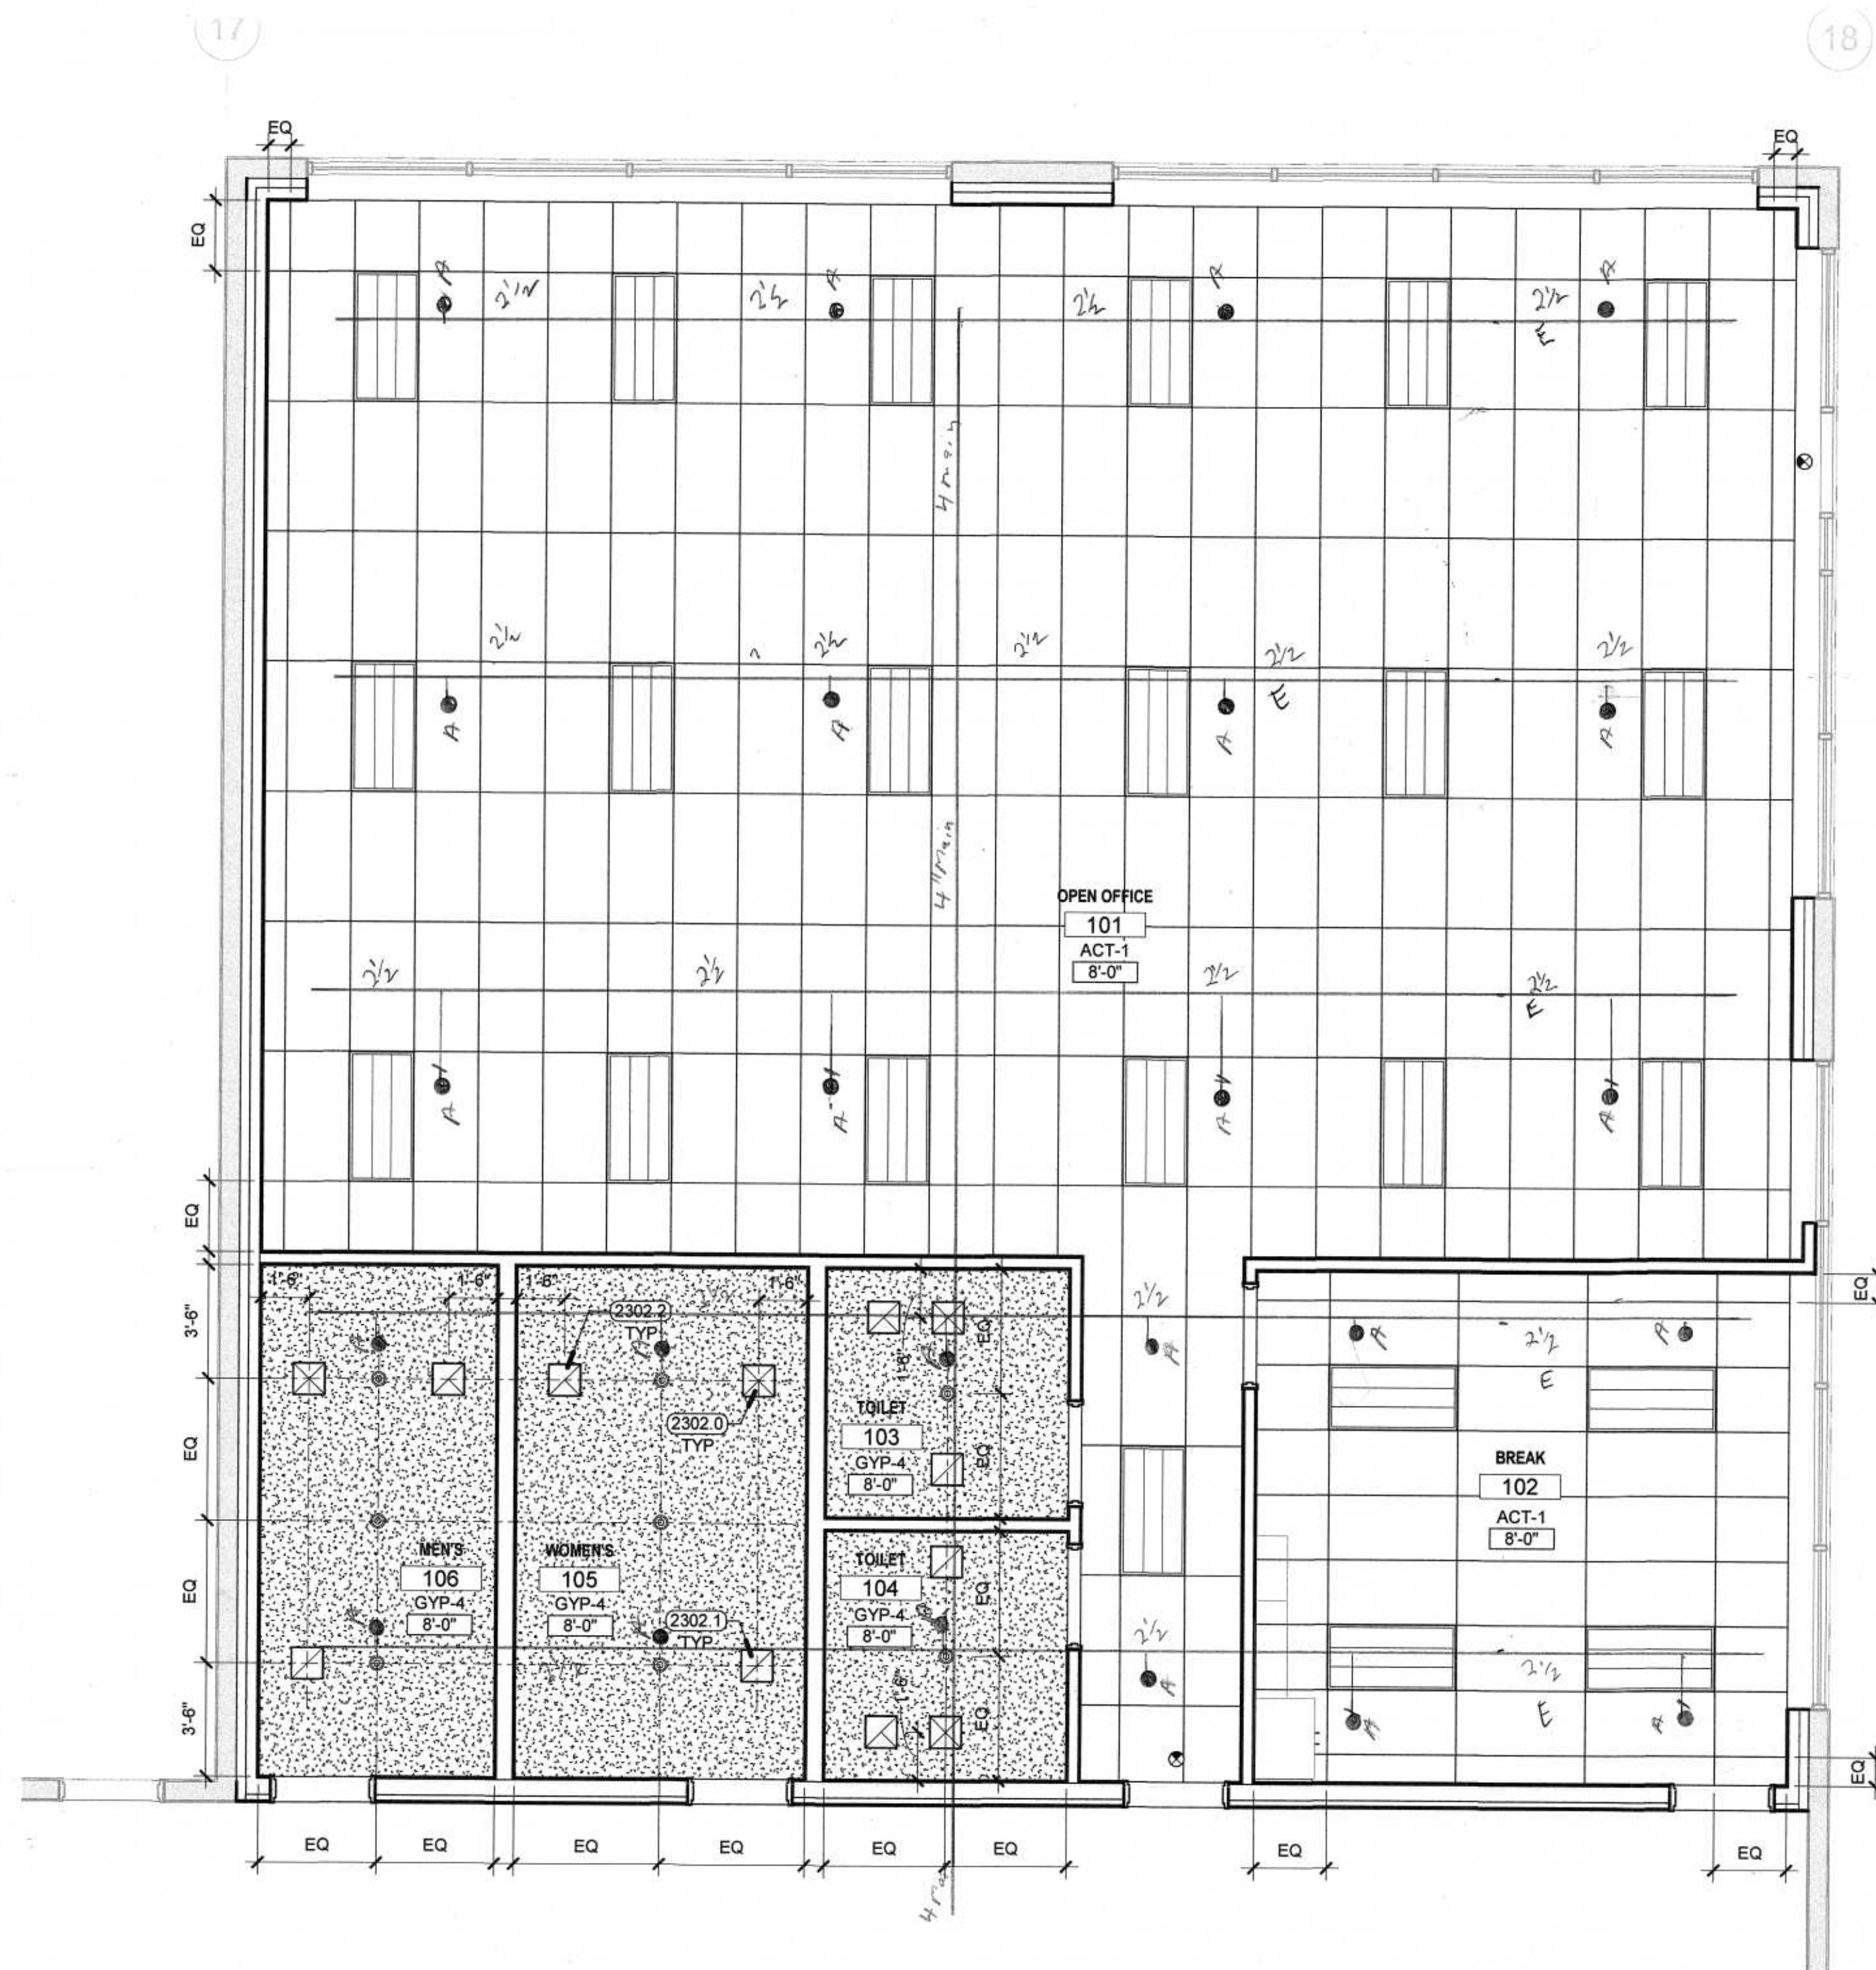


A4 RCP - OFFICE

SCALE: 1/4" = 1'-0"



**TEELOX MECHANICAL
BRANCH CONNECTOR**



SIZE	A	B	D
1-1/4 x 1/2	2	1-1/2	1-3/16
1-1/4 x 3/4	2 1/16	1-1/2	1-3/16
1-1/4 x 1	2 1/8	1-1/2	1-3/16
1-1/2 x 1/2	2	1-1/2	1-3/16
1-1/2 x 3/4	2 1/16	1-1/2	1-3/16
1-1/2 x 1	2 1/8	1-1/2	1-3/16
2 x 1/2	2 5/16	1-3/16	1-3/16
2 x 3/4	2 3/8	1-3/16	1-3/16
2 x 1	2 7/16	1-3/16	1-3/16
2 1/2 x 1/2	2 9/16	2-1/8	1-3/16
2 1/2 x 3/4	2 11/16	2-1/8	1-3/16
2 1/2 x 1	2 3/4	2-1/8	1-3/16

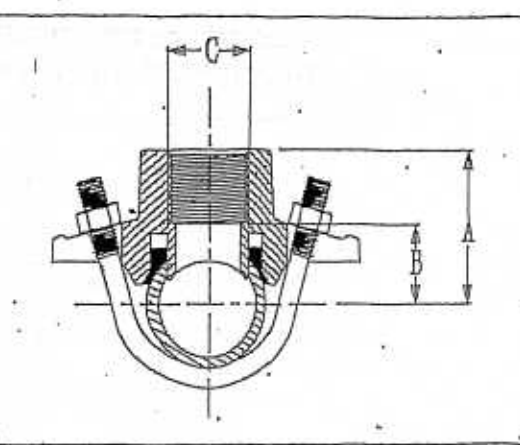

MAXIMUM DISTANCE BETWEEN HANGERS

NOMINAL PIPE SIZE (Inch)	1"	1-1/4"	1-1/2"	2"	2-1/2"	3"	4"	6"
STEEL PIPE (20-0)	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"
NON-STEEL PIPE (20-0)	8'-0"	8'-0"	8'-0"	8'-0"	8'-0"	8'-0"	8'-0"	8'-0"

NOTE: PIPE SIZE SHALL BE 1/2" FOR 1" AND LARGER.

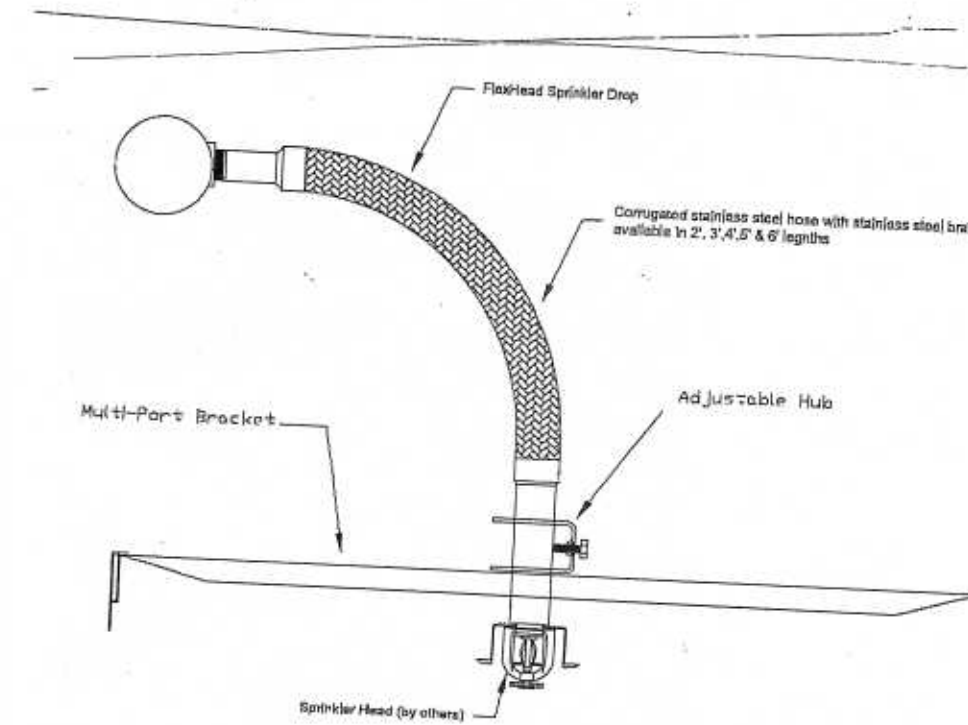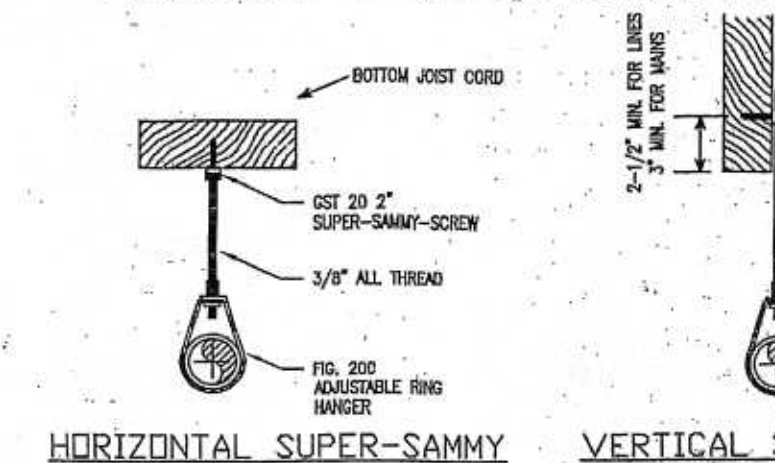

Design per NFPA 13 - Light Hazard 2022
All materials to be new, U.L. listed and F.M. approved
All heads to be at least 6' apart with no obstructions

WASHINGTON STATE
CERTIFICATE OF COMPETENCY
FIRE SPRINKLER SYSTEMS

John Thomas DeMartino
8794-1081-CG Level 3
Crown Fire Protection, Inc.
CROWNFFO44LL

JTD
Signature 10/16/25
Date

- 24 - Add Victaulic® FireLock™ V2708 Quick Response 155° Chrome Pendants 1/2 x 1/2



Riverfront Industrial Park
1601 Industrial Parkway
Suite 101
Puyallup, WA