



WEDDERMANN ARCHITECTURE
 JENNIFER WEDDERMANN, AIA, LEED AP
 4629 SOUTH YAKIMA
 TACOMA, WA 98408
 (253)-973-6611
 JENNIFER@WEDDERMANN.COM

REGISTERED ARCHITECT
 JENNIFER WEDDERMANN
 STATE OF WASHINGTON

FIRST REVIEW CORRECTION: In accordance with City Standard Section 304, the WATER SYSTEM NOTES must be shown on the plans. Include those on the site plan.
SECOND REVIEW CORRECTION: City Standard Section 304 WATER SYSTEM NOTES were not added to plans. Please paste the entire section of water system notes to the plans. Email Engineering Reviewer if you cannot locate the standards on the City website.

PROJECT NAME DON'S DRIVE-IN REPAIR
PROJECT DESCRIPTION UTILITY UPGRADE - WATERLINE SIZE INCREASE TO ACCOMMODATE SCOPE BELOW
 BUILDING PERMIT PRCT120242007
 REPAIR OF DAMAGED FOOD ESTABLISHMENT;
 NEW SUBMITTAL FOR REPLACED EQUIPMENT AND REUSED EQUIPMENT, AND REPAIR OF DAMAGED WALL
ADDRESS 925 S MERIDIAN
 PUYALLUP, WA 98371
JURISDICTION CITY PUYALLUP
ZONE CG - GENERAL COMMERCIAL
PARCEL NUMBER 0420342010
SITE AREA 0.241 Acres (10,500 sq. ft.)

LEGAL DESCRIPTION


SECTION 34 TOWNSHIP 20 RANGE 04 QUARTER 22 : BEG 30 FT E & 370.60 FT S OF NW COR SEC TH E 120 FT TH S 92.40 FT TH W 120 FT TH N 92.40 FT TO BEG TO SW S 7.60 FT TR 14 COFFMANS ADD TO PUY EXC W 15 FT DEEDED TO CY OF PUYALLUP UNDER ETN 599975 DATED OCT 10, 1983 (DCWJES8-28-84)

Call before you dig. It's the law.
 Dial 811 or call 1-800-424-5555.

Refer to the City standard details 02.03.02 & 05.02.01 for typical erosion and sedimentation control methods.

Any public facilities, i.e. utilities, curb, gutter, driveway approach, curb ramp, sidewalk, etc., broken now or during the course of construction shall be removed and replaced to current City Standard. Restoration limits and requirements shall be at the discretion of the City.

Also reference City Standard Detail 03.01.03-2 in callout for utility separation. Include detail on sheet 2.

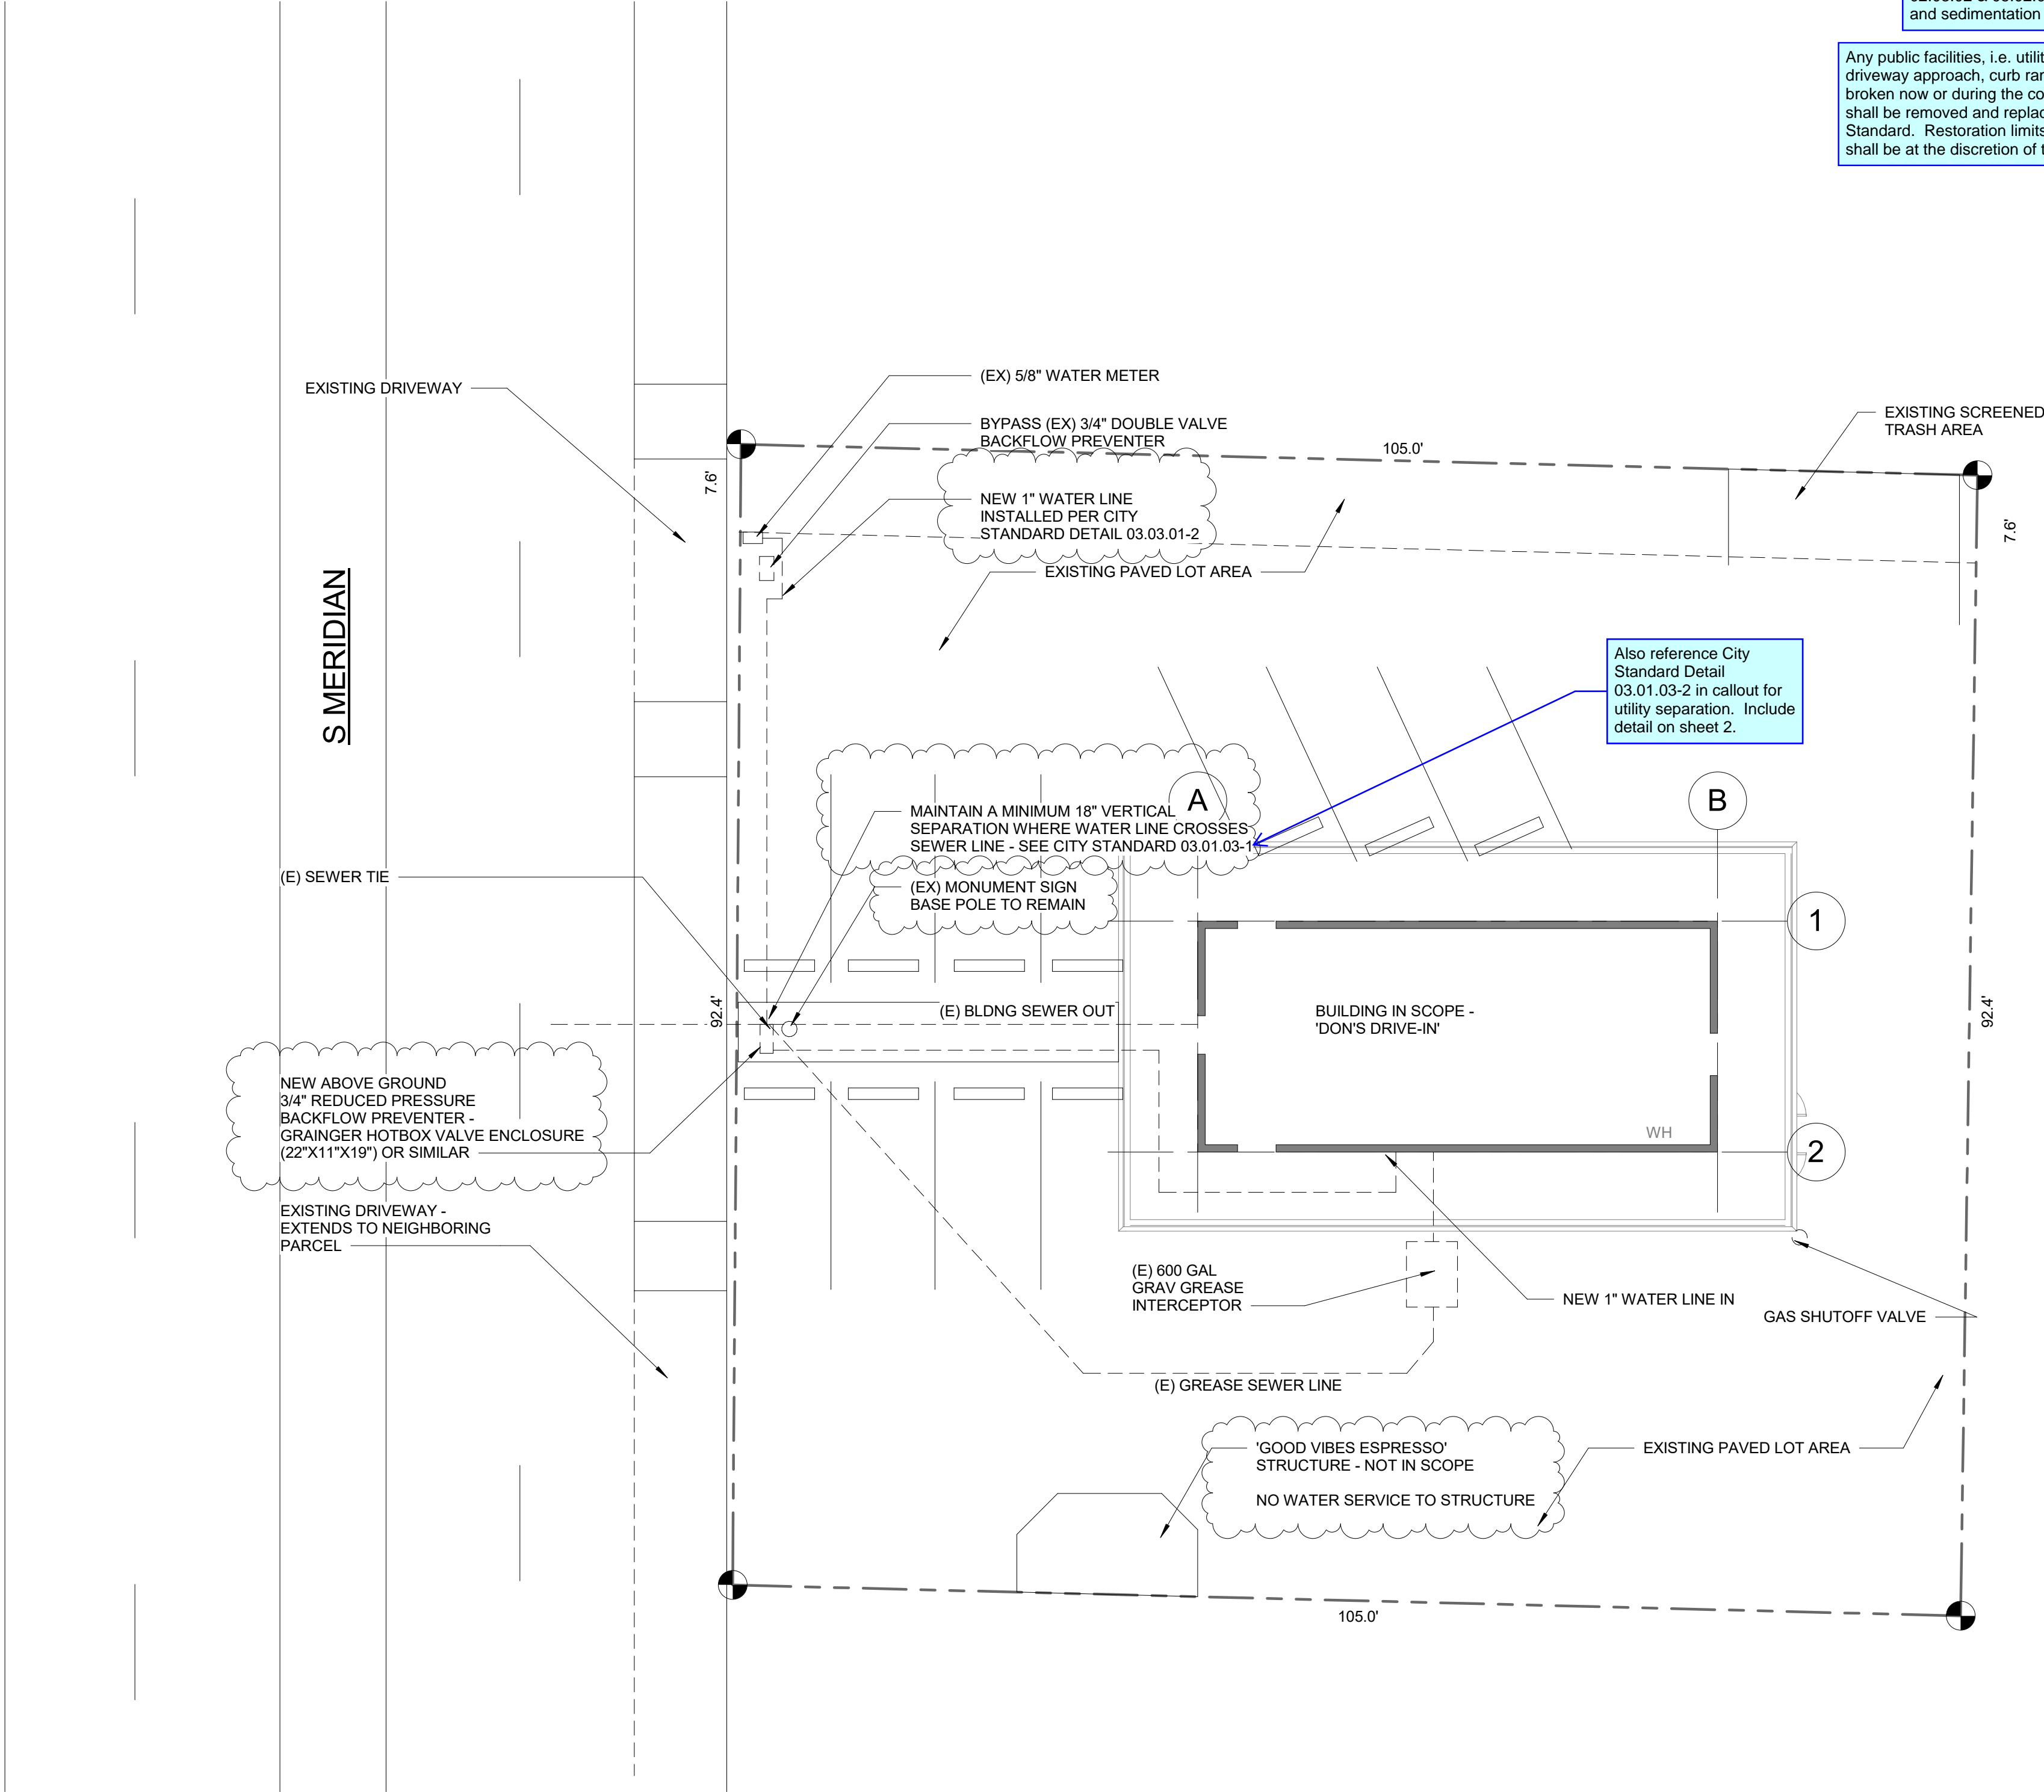

1 SITE PLAN
 1" = 10'-0" NORTH

PROJECT
 GINA BURKHAMMER
DON'S DRIVE-IN
 925 S MERIDIAN
 PUYALLUP, WA 98371

INFO	7/11/24	24041	DON'S DRIVE-IN RVT
Rev#	Date	Rev#	Date
1	Date 1	Revision 1	Revision 1


SHEET NAME
 SITE PLAN
 PROGRESS SET

SHEET NO.
 A1.01

REVISIONS	DESCRIPTION	DATE
1	Revision 1	Date 1

INFO	Rev#	Date
7/11/24	24041	2024

SHEET NAME	DATE
SITE - DETAILS	2/15/2018

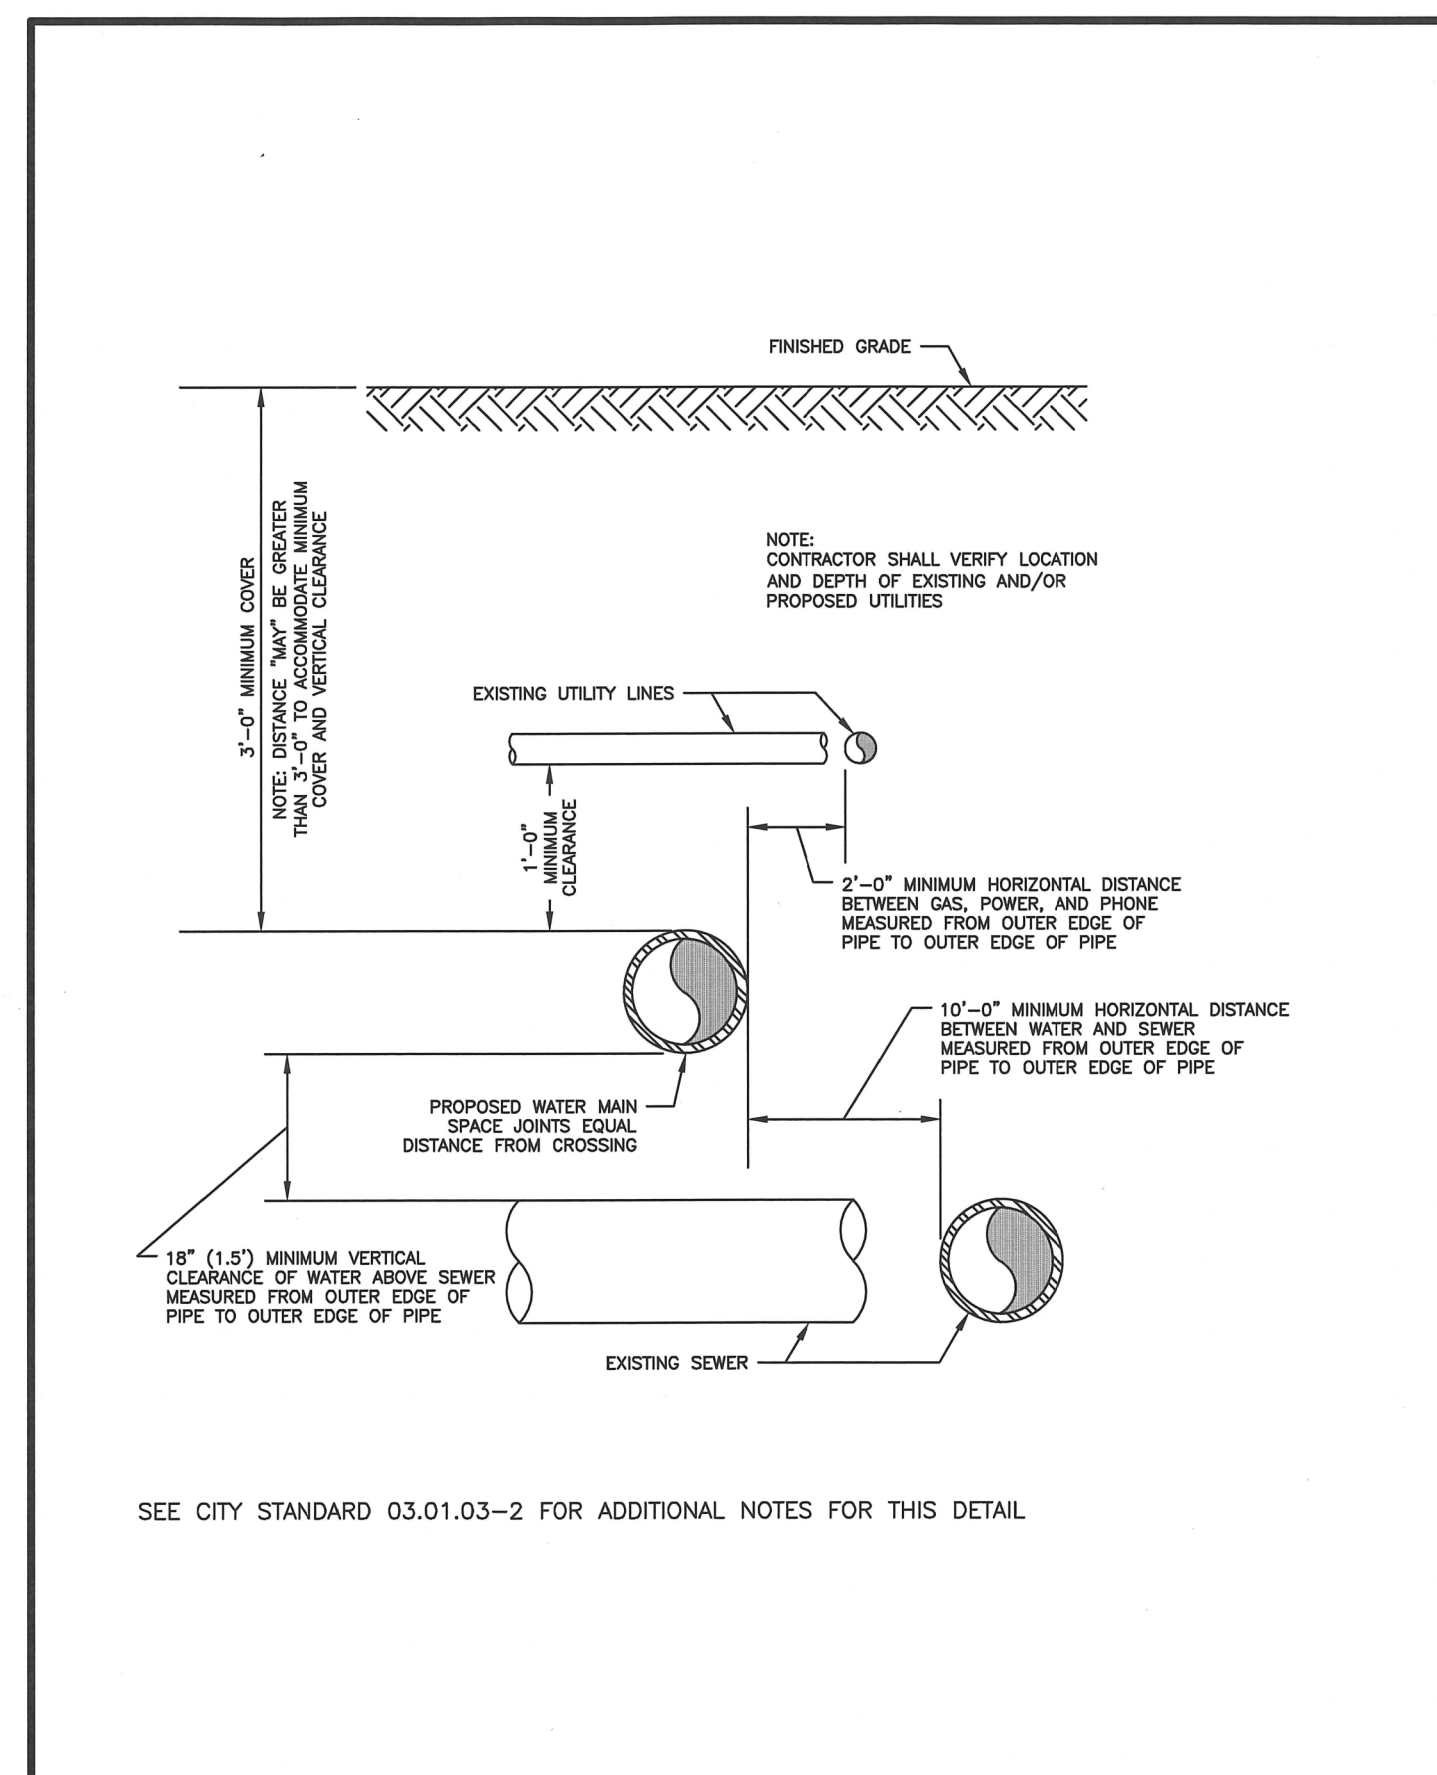


CITY OF PUYALLUP
 OFFICE OF THE CITY ENGINEER

APPROVED FOR PUBLICATION

WATER MAIN CROSSING OTHER UTILITIES

CITY STANDARD 03.01.03-1

DATE SEAL: 2/15/2018

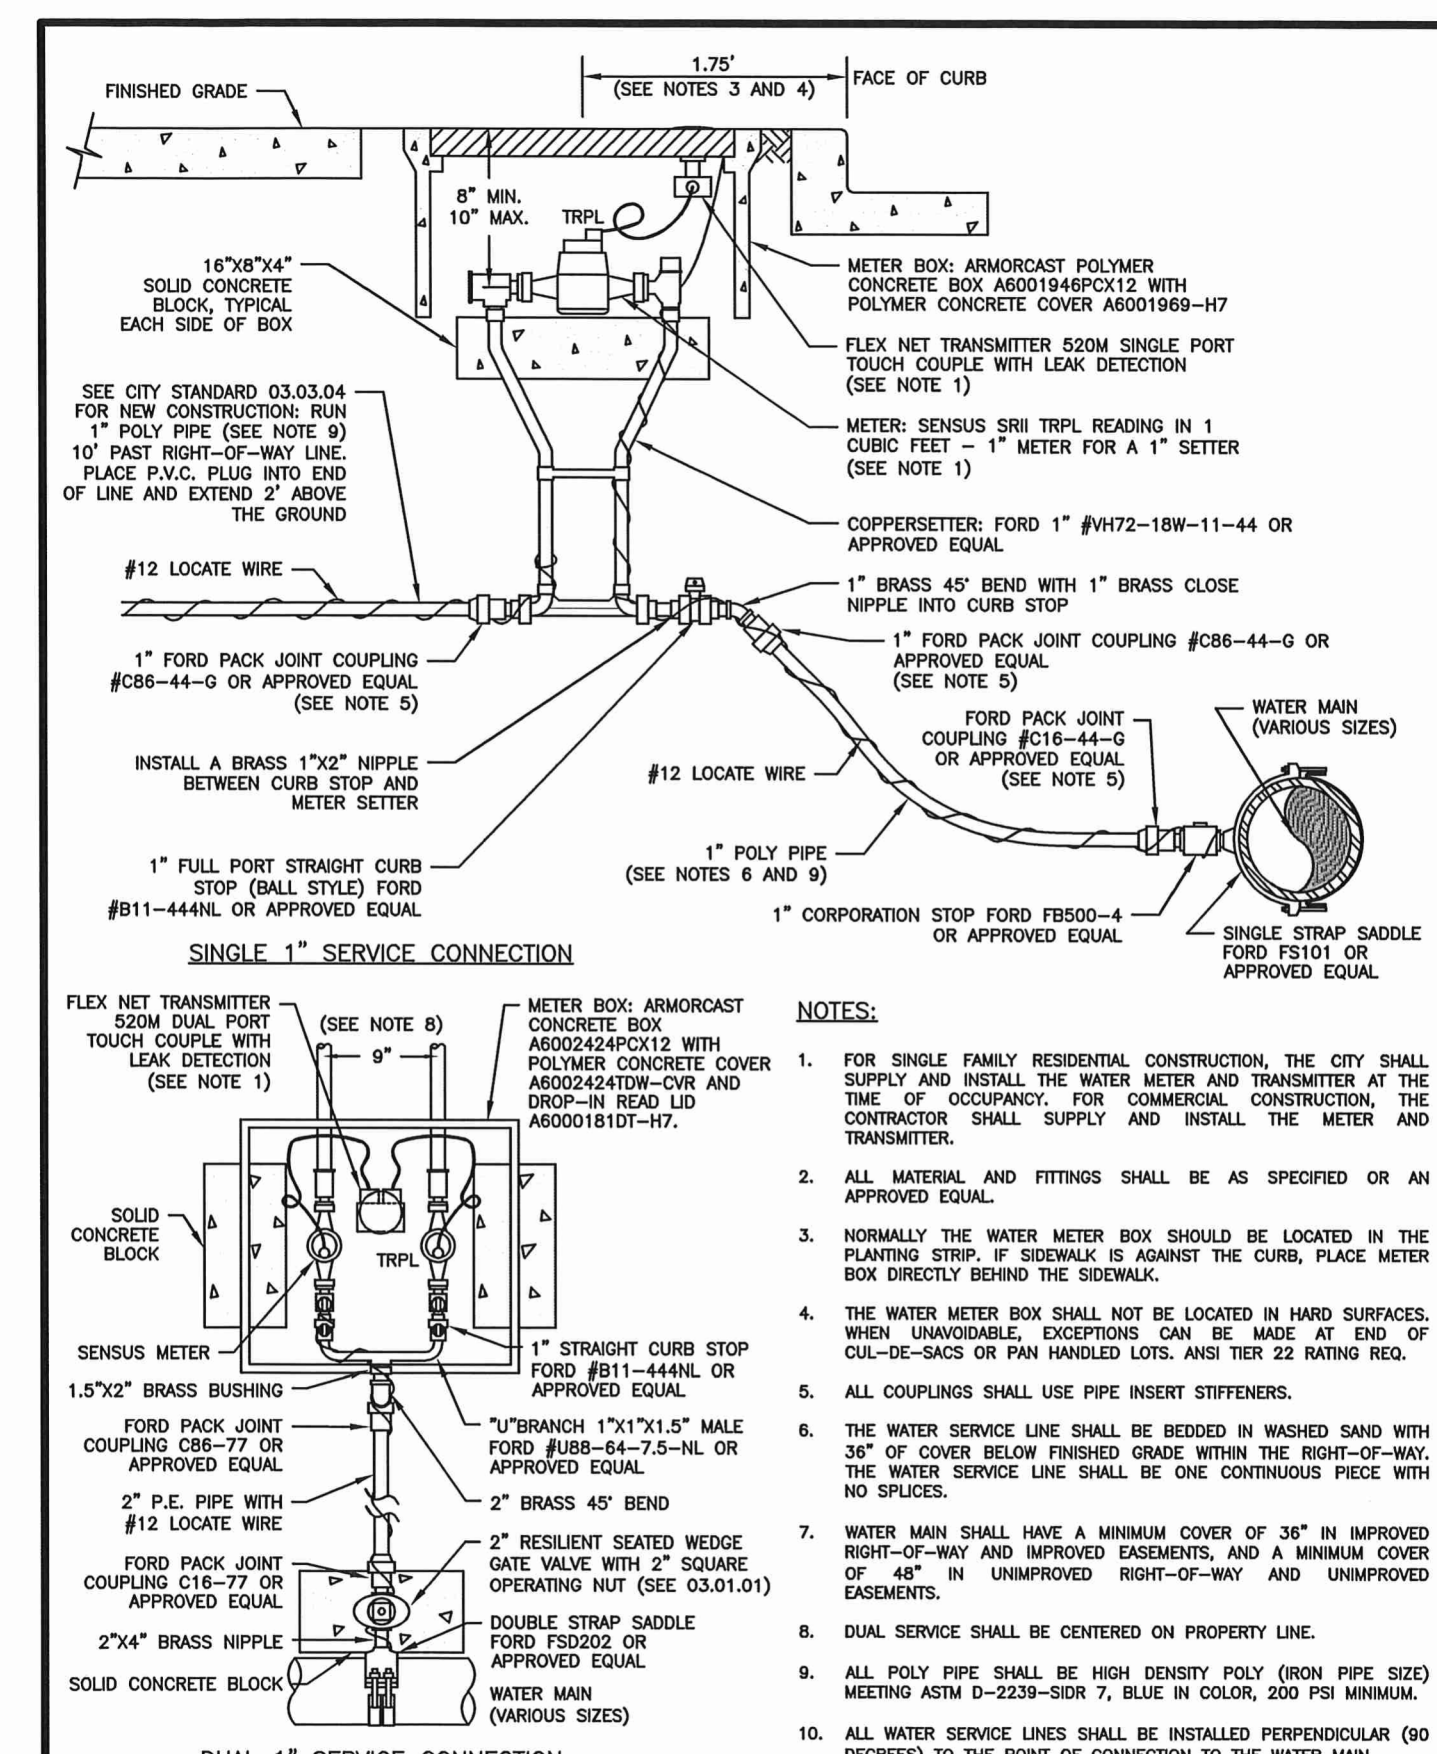


CITY OF PUYALLUP
 PUBLIC WORKS AND DEVELOPMENT ENGINEERING

APPROVED FOR PUBLICATION

1" WATER SERVICE CONNECTION

CITY STANDARD 03.03.01-2

DATE SEAL: 2/15/2018

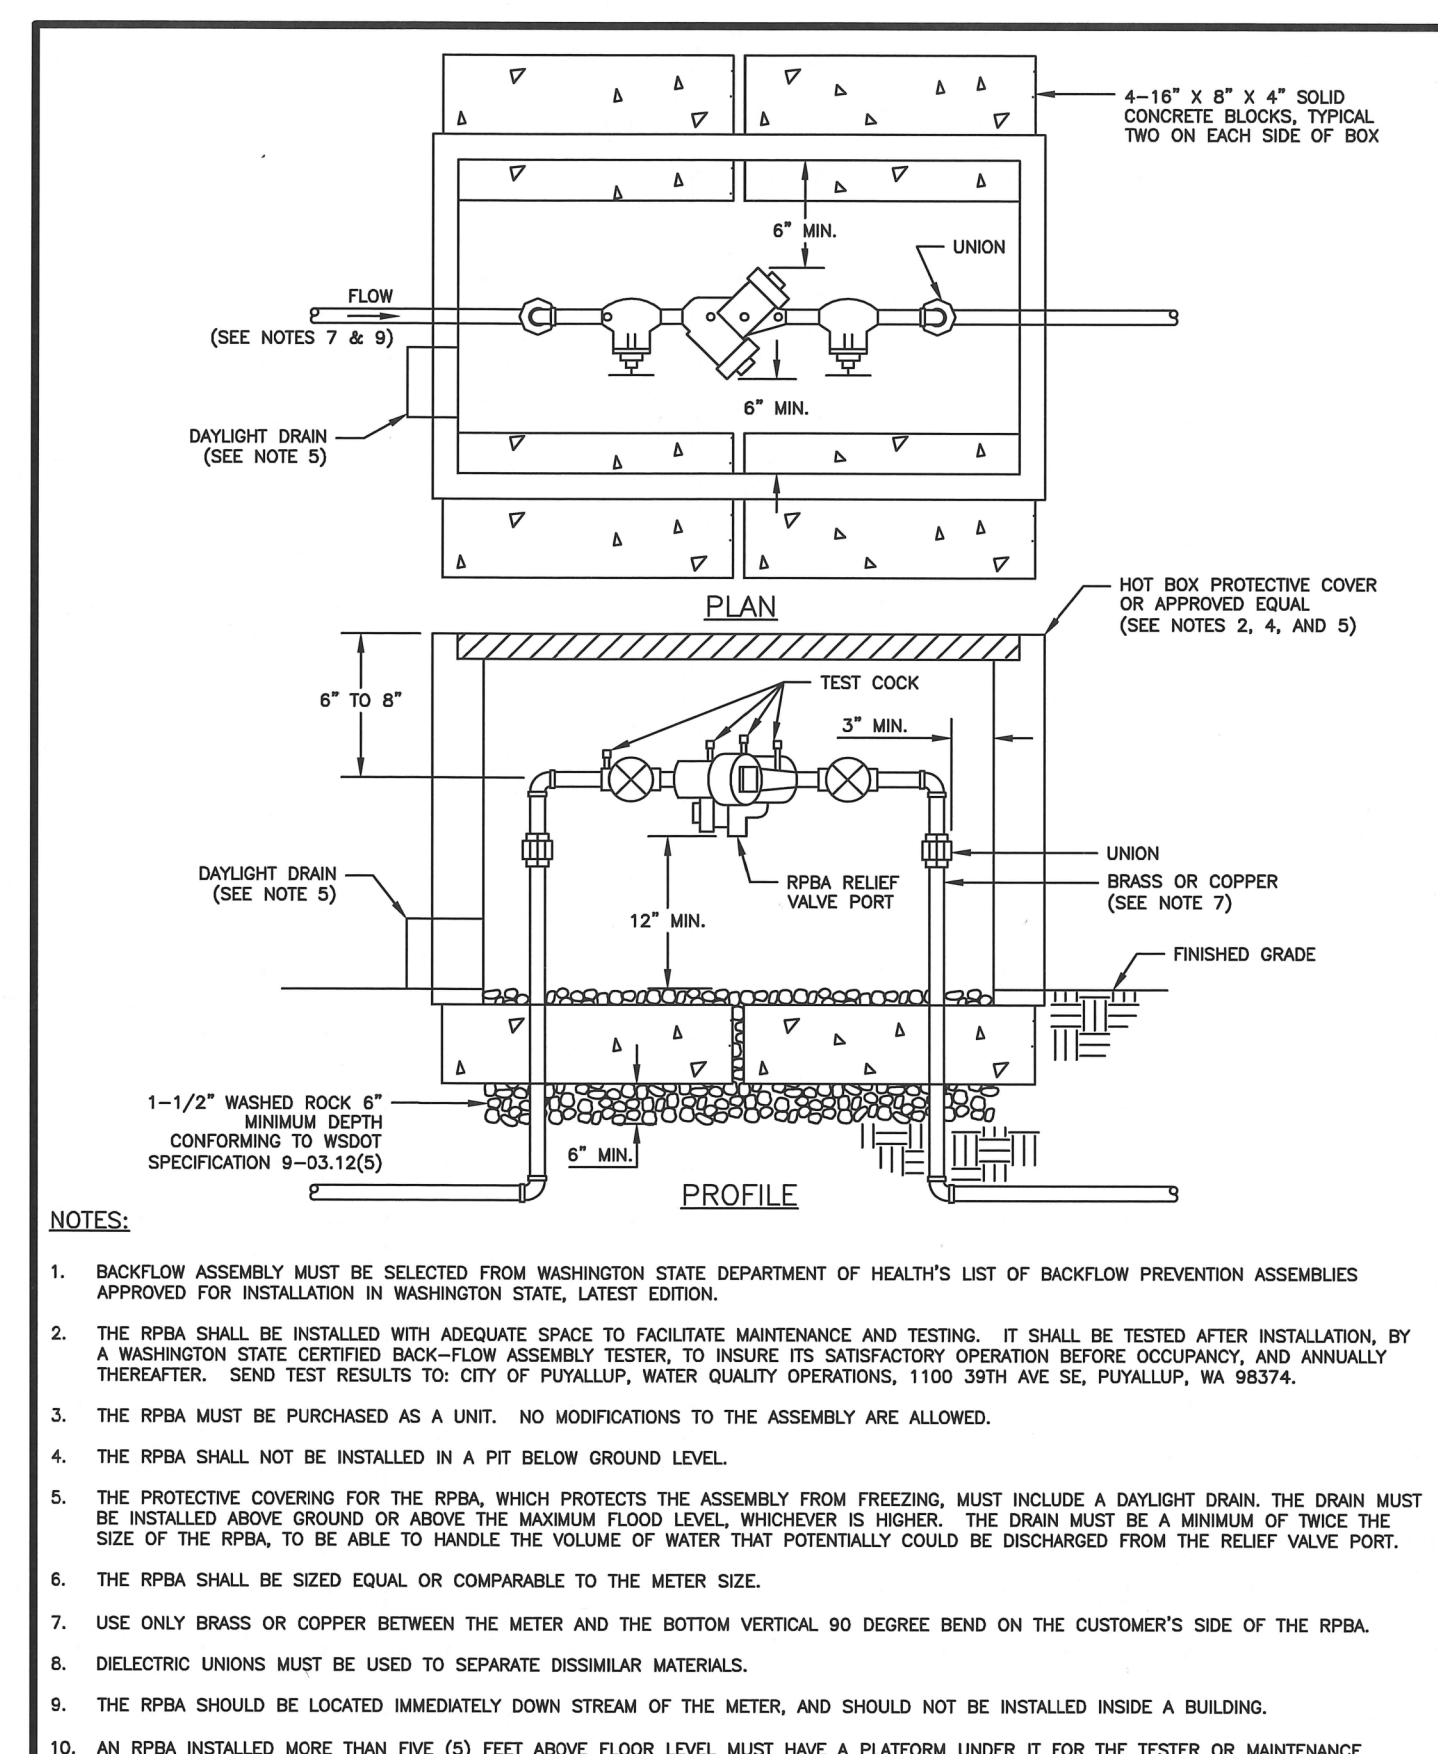

CITY OF PUYALLUP
 OFFICE OF THE CITY ENGINEER

APPROVED FOR PUBLICATION

2" AND SMALLER REDUCED PRESSURE BACKFLOW ASSEMBLY INSTALLATION

CITY STANDARD 03.04.02

DATE SEAL: 2/15/2018