

NOTES:

1. TANK, PUMP, DISPENSERS, MECHANICAL SHUTOFF, AND RELATED PROPANE PIPING PROVIDED AND SET IN PLACE BY FERRELLGAS ON EXISTING ASPHALT SURFACE.
2. CONTRACTOR WILL PROVIDE LINE VOLTAGE CONDUIT, WIRING, CONNECTIONS, AND DISCONNECTS (AS REQUIRED) FOR PUMP, FUEL DISPENSERS, EMERGENCY SHUTOFF, AND FUEL MANAGEMENT KIOSK.
3. EXTEND CONDUITS ABOVE GRADE TO A NEMA 3R PULL BOX. PROVIDE CIRCUITS AS REQUIRED TO COMPLETE ALL CONNECTIONS (SEE NOTE 2). PROVIDE A SEPARATE BOX FOR LOW VOLTAGE CABLE DISTRIBUTION.


4. INSTALL FUEL MANAGEMENT KIOSK AND SYSTEM COMPONENTS FOR A COMPLETE AND FUNCTIONAL SYSTEM. PROVIDE A PETROVEND OPW PV200 TERMINAL ON A PEDESTAL, MAGNETIC CARD READER, PROXIMITY CARD READER, FUEL SITE CONTROLLER, LCD TOUCHSCREEN DISPLAY, AND RELATED COMPONENTS FOR A COMPLETE SYSTEM. PROVIDE OPW PHOENIX SOFTWARE ON A DISTRICT COMPUTER COMPATIBLE WITH EXISTING DISTRICT SOFTWARE.
5. PROVIDE AN EMERGENCY SHUTOFF SWITCH ON THE SOUTH SIDE OF THE POWER/COMM ENCLOSURE.
6. PROVIDE AN 18 LB. B:C FIRE EXTINGUISHER IN A STAINLESS STEEL CABINET MOUNTED ON A POST.
7. STARTUP AND COMMISSIONING WILL BE DONE BY FERRELLGAS WITH PARTICIPATION BY CONTRACTOR.

**2021 Washington State Fuel Gas Code:**  
**412.2 Storage and Dispensing**  
 Storage vessels and equipment used for the storage or dispensing of LP-gas shall be approved or listed in accordance with Sections 412.3 and 412.4

**412.3 Approved Equipment**  
 Containers; pressure-relief devices, including pressure-relief valves; and pressure regulators and piping used for LP-gas shall be approved.

**412.4 Listed Equipment**  
 Hoses, hose connections, vehicle fuel connections, dispensers, LP-gas pumps and electrical equipment used for LP-gas shall be listed.

**2021 Washington State Fuel Gas Code:**  
**412.8.2 Hoses**  
 Hoses and piping for the dispensing of LP-gas shall be provided with hydrostatic relief valves. The hose length shall not exceed 18 feet (5486 mm). An approved method shall be provided to protect the hose against mechanical damage.

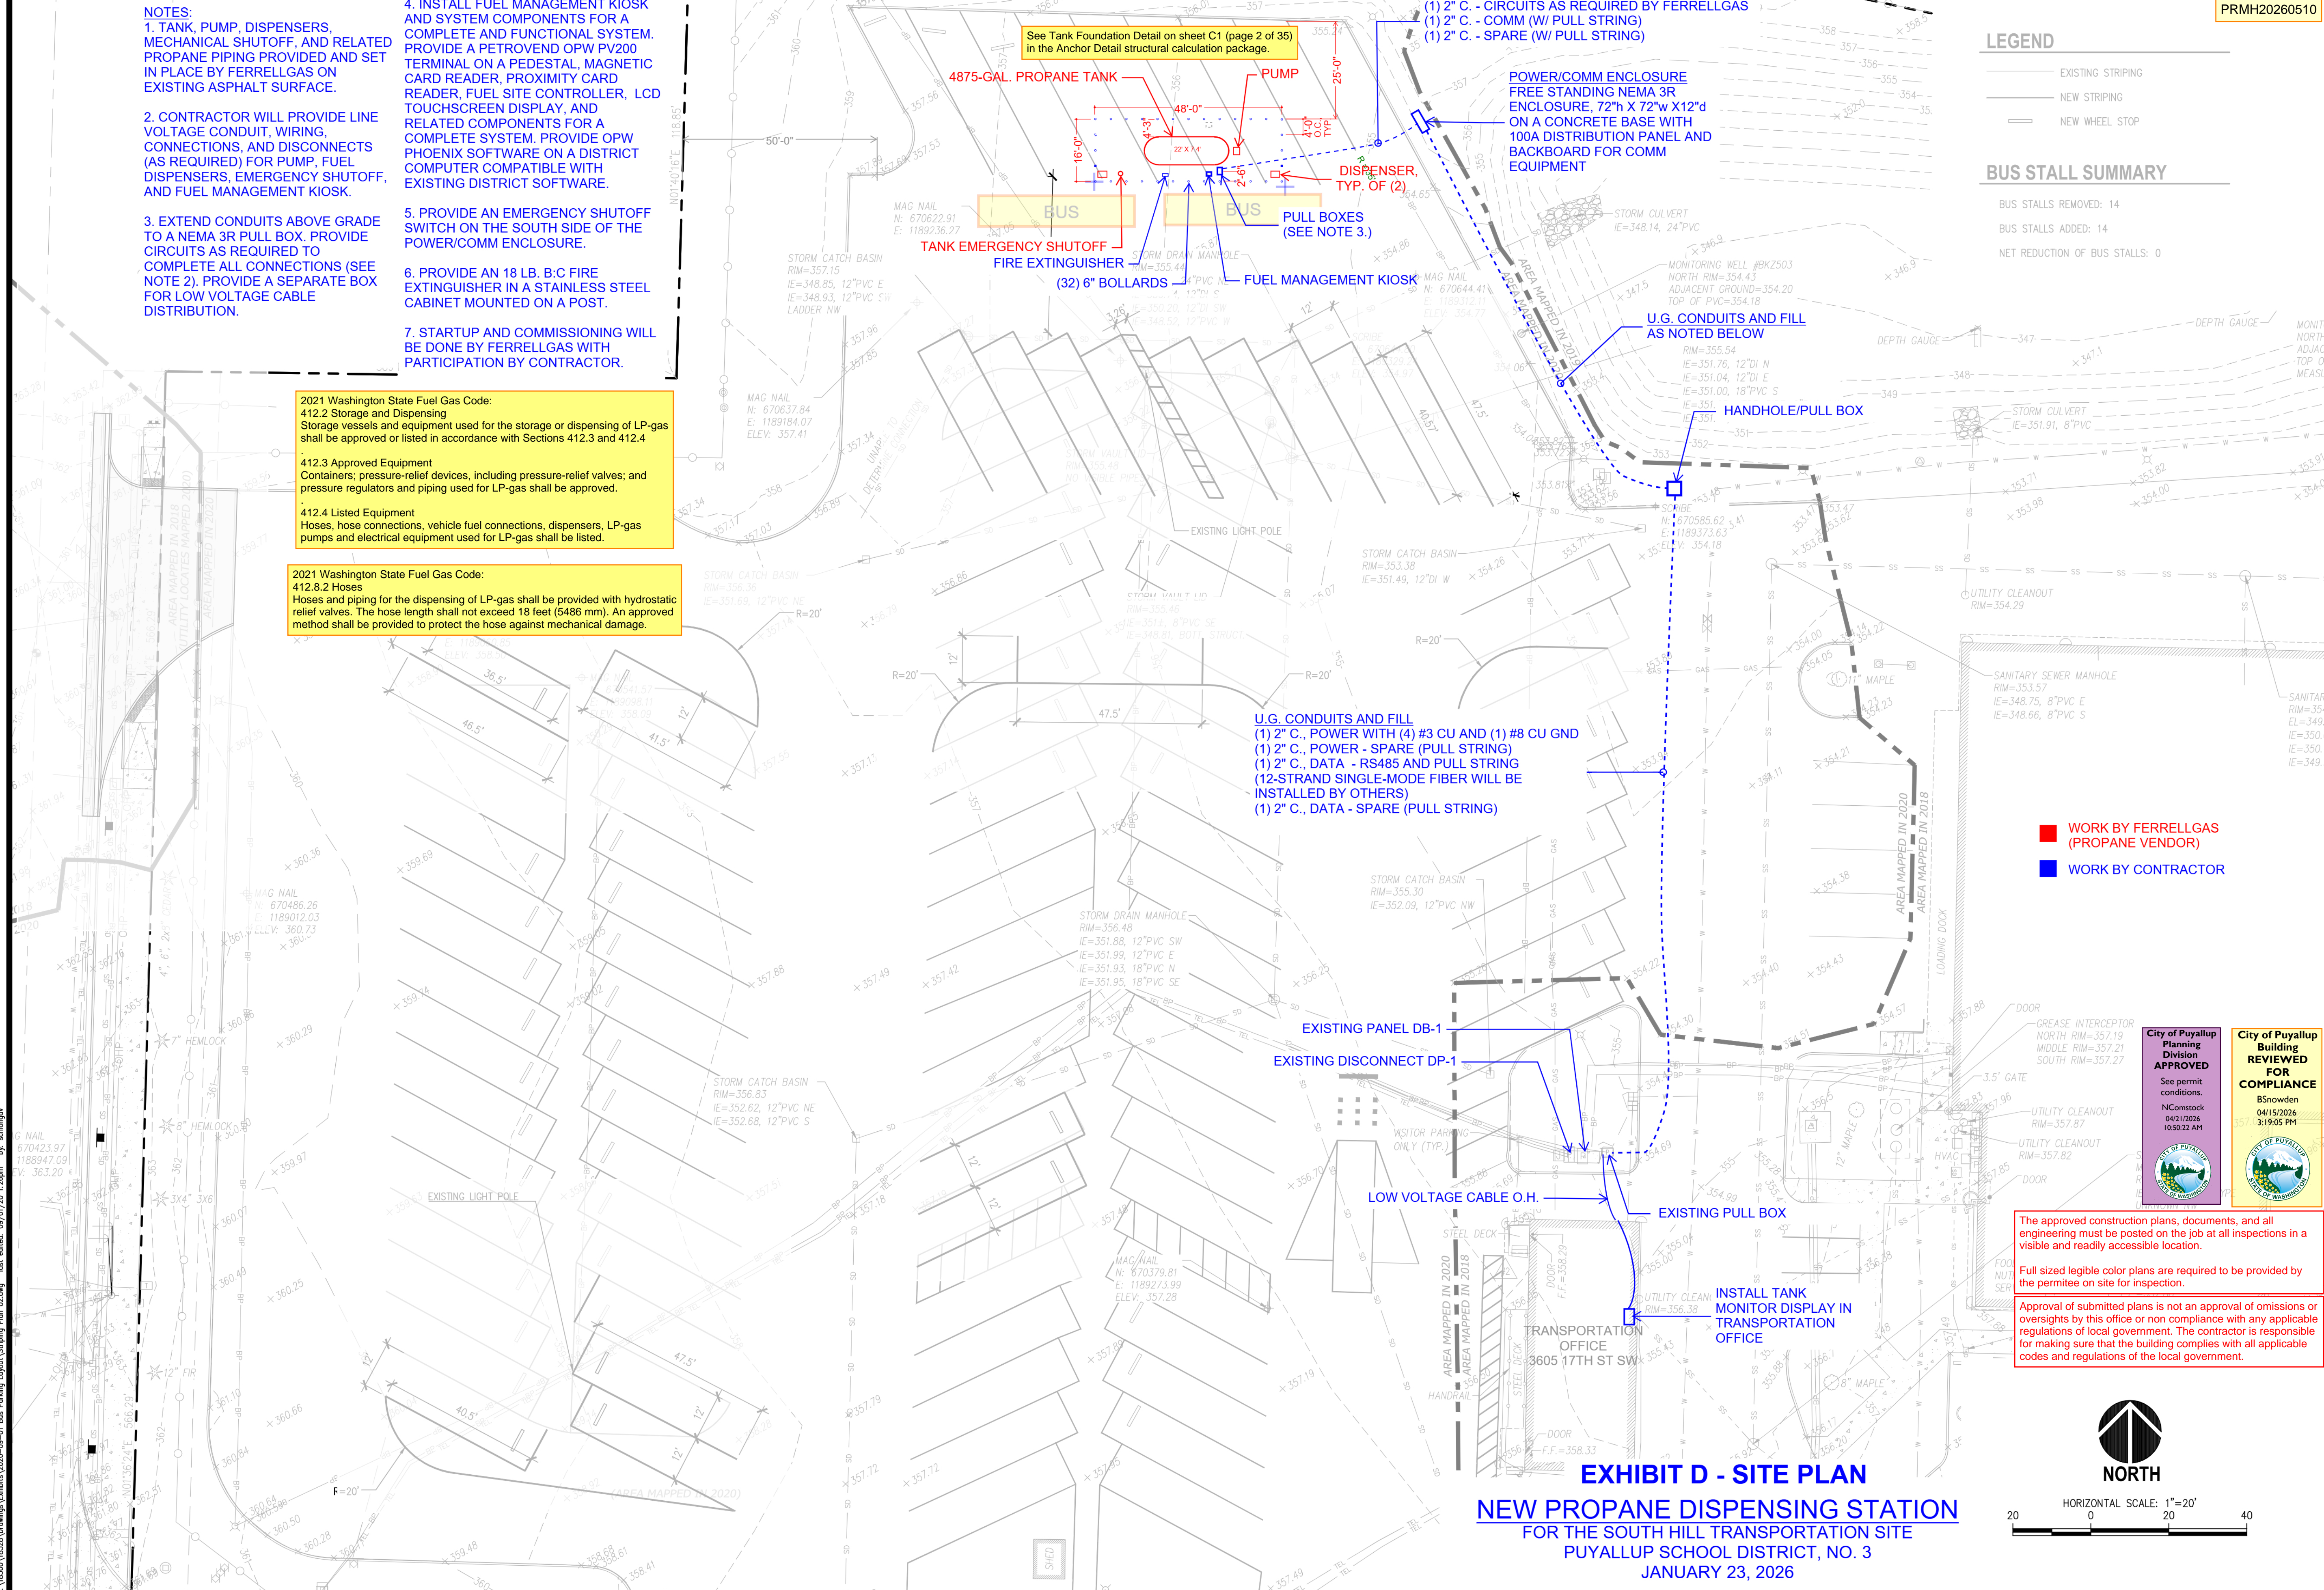

**LEGEND**

- EXISTING STRIPING
- NEW STRIPING
- NEW WHEEL STOP

**BUS STALL SUMMARY**

BUS STALLS REMOVED: 14  
 BUS STALLS ADDED: 14  
 NET REDUCTION OF BUS STALLS: 0

**U.G. CONDUITS AND FILL**  
 (1) 2" C., POWER WITH (4) #3 CU AND (1) #8 CU GND  
 (1) 2" C., POWER - SPARE (PULL STRING)  
 (1) 2" C., DATA - RS485 AND PULL STRING  
 (12-STRAND SINGLE-MODE FIBER WILL BE INSTALLED BY OTHERS)  
 (1) 2" C., DATA - SPARE (PULL STRING)

- WORK BY FERRELLGAS (PROPANE VENDOR)
- WORK BY CONTRACTOR

**City of Puyallup Planning Division APPROVED**  
 See permit conditions.  
 NComstock 04/15/2026 10:50:22 AM


**City of Puyallup Building Reviewed FOR COMPLIANCE**  
 BSnowden 04/15/2026 3:19:05 PM

The approved construction plans, documents, and all engineering must be posted on the job at all inspections in a visible and readily accessible location.

Full sized legible color plans are required to be provided by the permittee on site for inspection.

Approval of submitted plans is not an approval of omissions or oversights by this office or non compliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable codes and regulations of the local government.

**EXHIBIT D - SITE PLAN**  
**NEW PROPANE DISPENSING STATION**  
 FOR THE SOUTH HILL TRANSPORTATION SITE  
 PUYALLUP SCHOOL DISTRICT, NO. 3  
 JANUARY 23, 2026

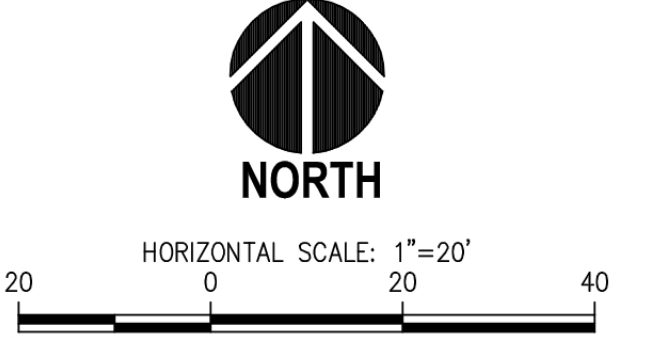

C:\1830\18328\Drawings\Exhibits\2026-09-01 Bus Parking Layout\Shipping Plan 02.dwg last edited: 09/07/20 12:28pm by schongor

DESIGNED: VMS  
 DRAWN: VMS  
 CHECKED: RCH  
 DATE: 08/25/2020  
 SCALE: AS NOTED

APPROVALS

PREPARED BY: **SITTS & HILL ENGINEERS, INC.**  
 CIVIL - STRUCTURAL - SURVEYING  
 4815 CENTER STREET | TACOMA, WA 98409  
 PHONE: (253) 474-9449 | FAX: (253) 474-0153  
 http://www.sittshill.com/

PROJECT: **SUPPORT CAMPUS BUS**  
 SHEET TITLE: **PUYALLUP SCHOOL DISTRICT NO. 3**  
 SHEET NO.: **1**  
 PROJECT NO.: **1501 39TH AVENUE SW, PUYALLUP, WA**