

NOTES:

1. TANK, PUMP, DISPENSERS, MECHANICAL SHUTOFF, AND RELATED PROPANE PIPING PROVIDED AND SET IN PLACE BY FERRELLGAS ON EXISTING ASPHALT SURFACE.
2. CONTRACTOR WILL PROVIDE LINE VOLTAGE CONDUIT, WIRING, CONNECTIONS, AND DISCONNECTS (AS REQUIRED) FOR PUMP, FUEL DISPENSERS, EMERGENCY SHUTOFF, AND FUEL MANAGEMENT KIOSK.
3. EXTEND CONDUITS ABOVE GRADE TO A NEMA 3R PULL BOX. PROVIDE CIRCUITS AS REQUIRED TO COMPLETE ALL CONNECTIONS (SEE NOTE 2). PROVIDE A SEPARATE BOX FOR LOW VOLTAGE CABLE DISTRIBUTION.

4. INSTALL FUEL MANAGEMENT KIOSK AND SYSTEM COMPONENTS FOR A COMPLETE AND FUNCTIONAL SYSTEM. PROVIDE A PETROVEND OPW PV200 TERMINAL ON A PEDESTAL, MAGNETIC CARD READER, PROXIMITY CARD READER, FUEL SITE CONTROLLER, LCD TOUCHSCREEN DISPLAY, AND RELATED COMPONENTS FOR A COMPLETE SYSTEM. PROVIDE OPW PHOENIX SOFTWARE ON A DISTRICT COMPUTER COMPATIBLE WITH EXISTING DISTRICT SOFTWARE.
5. PROVIDE AN EMERGENCY SHUTOFF SWITCH ON THE SOUTH SIDE OF THE POWER/COMM ENCLOSURE.
6. PROVIDE AN 18 LB. B:C FIRE EXTINGUISHER IN A STAINLESS STEEL CABINET MOUNTED ON A POST.
7. STARTUP AND COMMISSIONING WILL BE DONE BY FERRELLGAS WITH PARTICIPATION BY CONTRACTOR.


2021 Washington State Fuel Gas Code:
412.2 Storage and Dispensing
 Storage vessels and equipment used for the storage or dispensing of LP-gas shall be approved or listed in accordance with Sections 412.3 and 412.4

412.3 Approved Equipment
 Containers; pressure-relief devices, including pressure-relief valves; and pressure regulators and piping used for LP-gas shall be approved.

412.4 Listed Equipment
 Hoses, hose connections, vehicle fuel connections, dispensers, LP-gas pumps and electrical equipment used for LP-gas shall be listed.

2021 Washington State Fuel Gas Code:
412.8.2 Hoses
 Hoses and piping for the dispensing of LP-gas shall be provided with hydrostatic relief valves. The hose length shall not exceed 18 feet (5486 mm). An approved method shall be provided to protect the hose against mechanical damage.

No proposed footings, posts, or supports shall be constructed on or above any existing public utility connections without first relocating the utility services or protecting it in place.

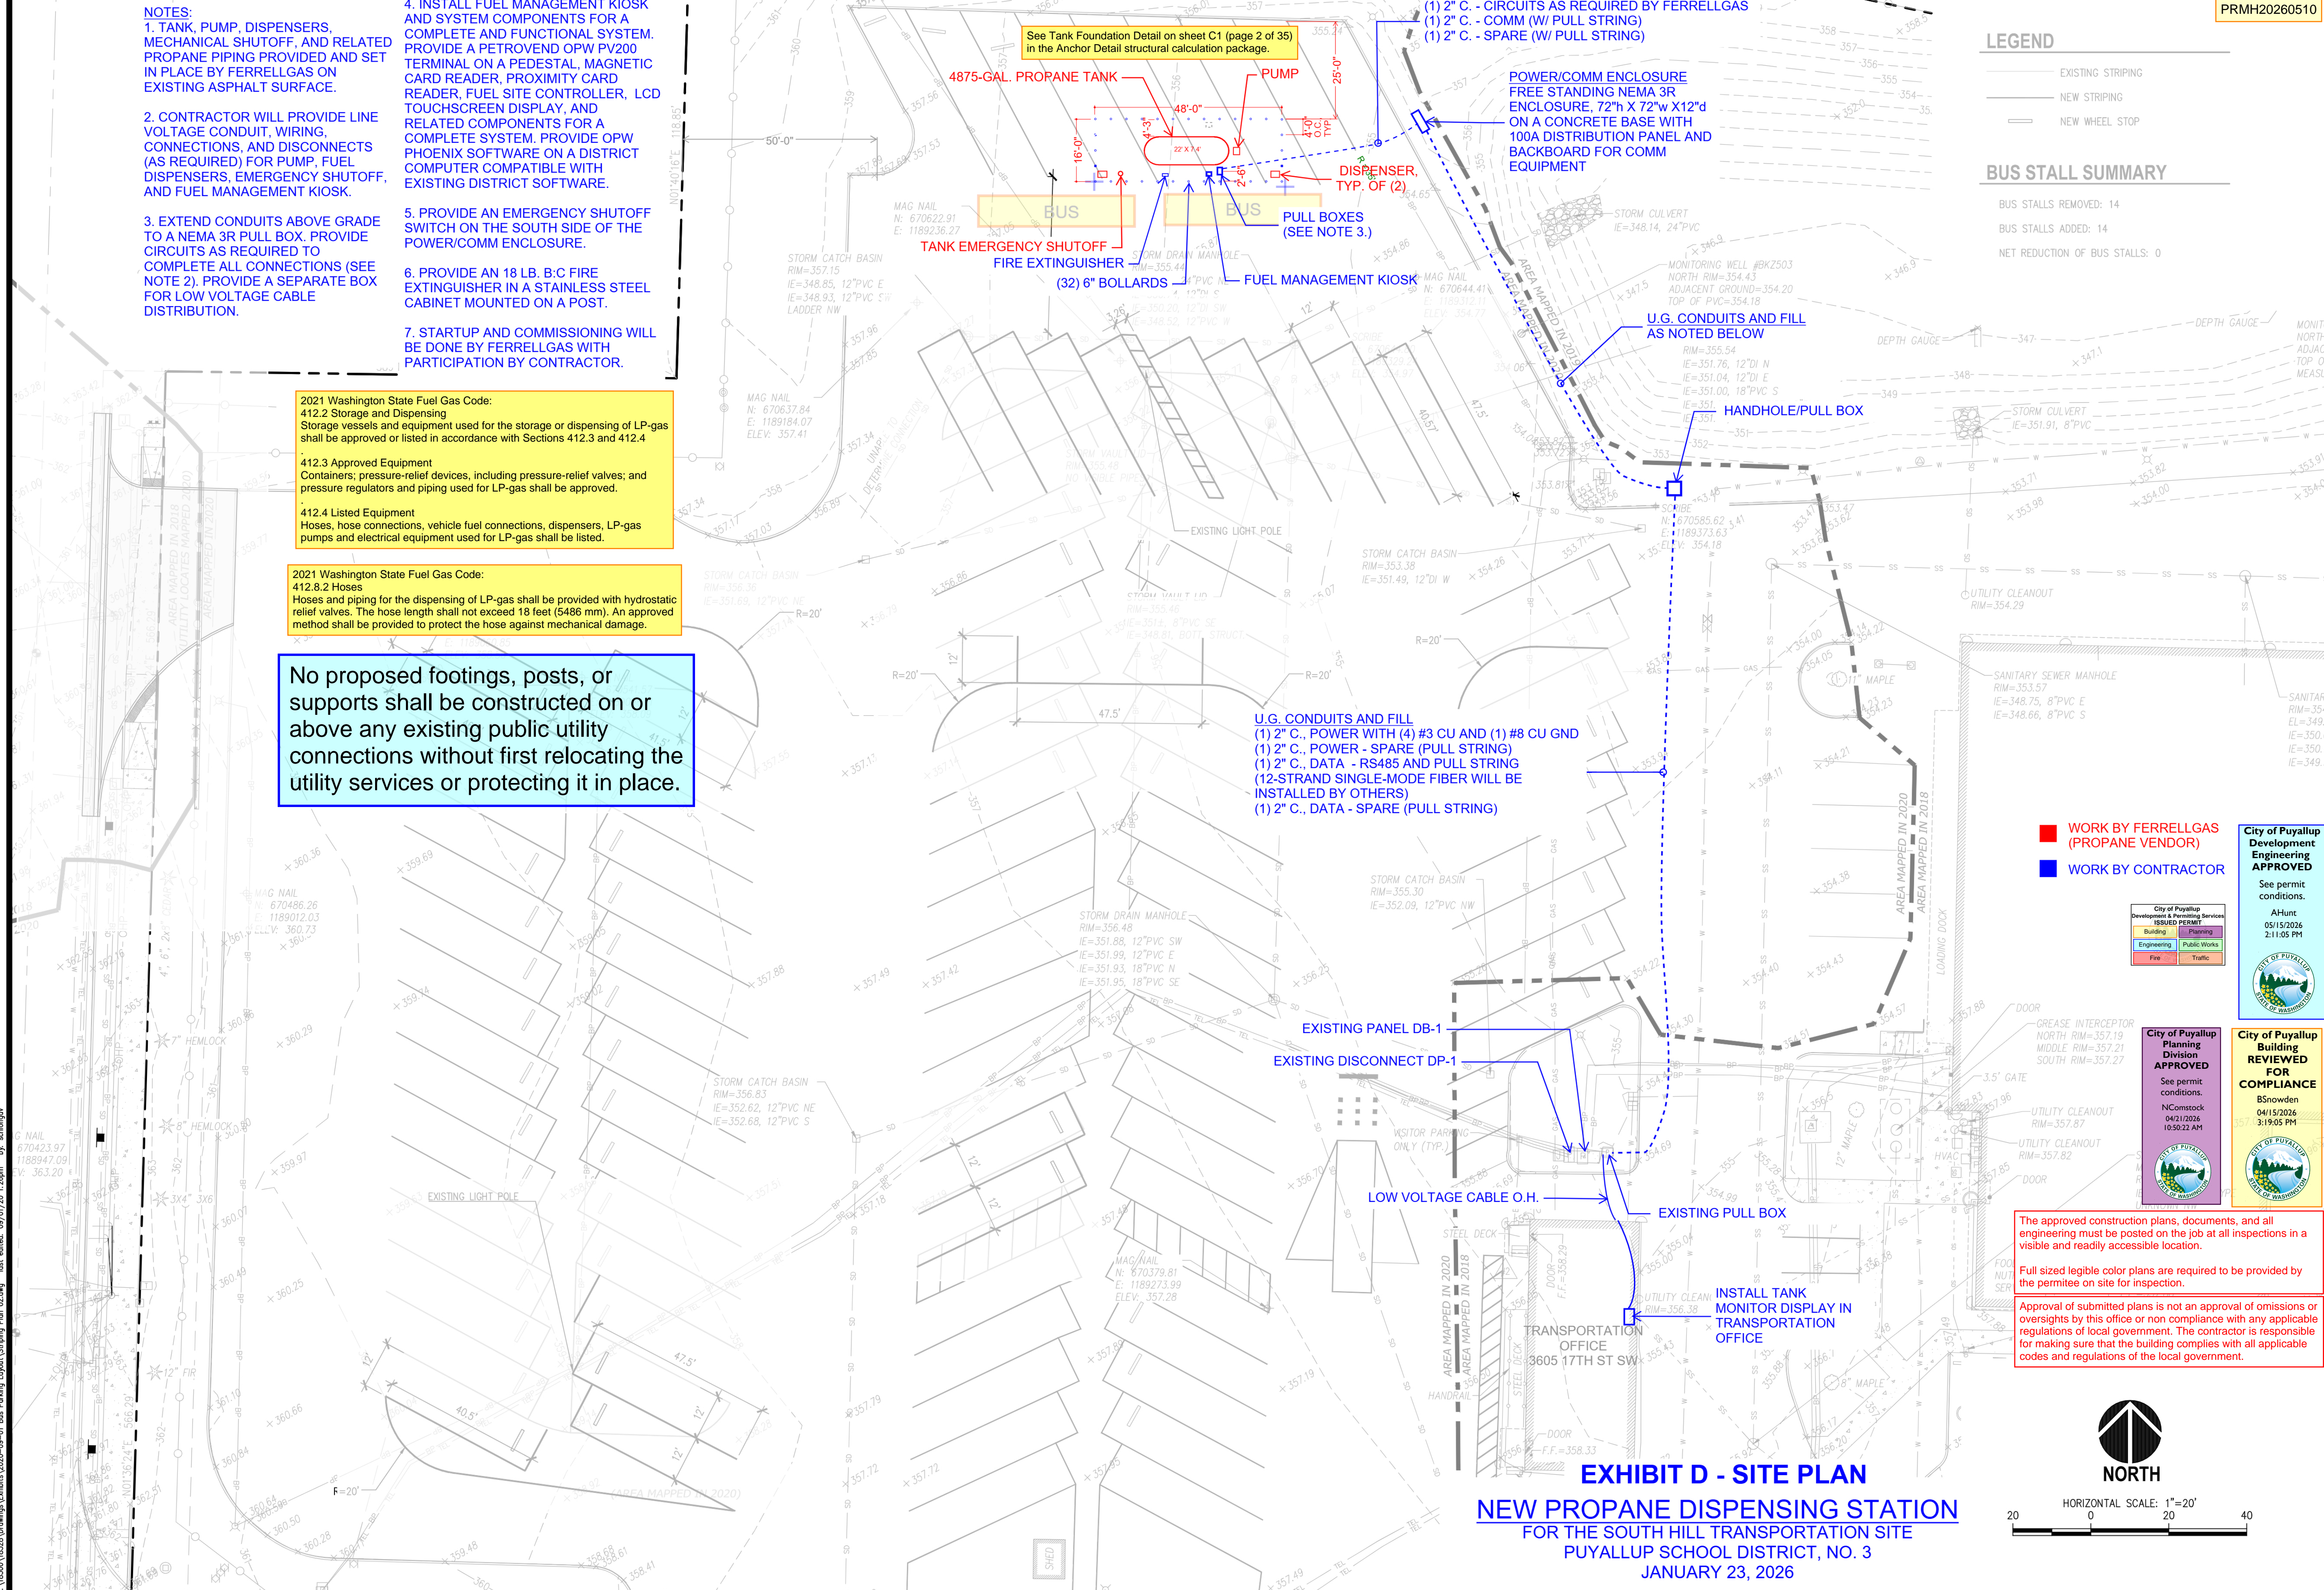

LEGEND

- EXISTING STRIPING
- NEW STRIPING
- NEW WHEEL STOP

BUS STALL SUMMARY

BUS STALLS REMOVED:	14
BUS STALLS ADDED:	14
NET REDUCTION OF BUS STALLS:	0

- (1) 2" C. - CIRCUITS AS REQUIRED BY FERRELLGAS
- (1) 2" C. - COMM (W/ PULL STRING)
- (1) 2" C. - SPARE (W/ PULL STRING)

- U.G. CONDUITS AND FILL**
 (1) 2" C., POWER WITH (4) #3 CU AND (1) #8 CU GND
 (1) 2" C., POWER - SPARE (PULL STRING)
 (1) 2" C., DATA - RS485 AND PULL STRING
 (12-STRAND SINGLE-MODE FIBER WILL BE INSTALLED BY OTHERS)
 (1) 2" C., DATA - SPARE (PULL STRING)

- WORK BY FERRELLGAS (PROPANE VENDOR)
- WORK BY CONTRACTOR

City of Puyallup
 Development & Planning Services
Engineering APPROVED
 See permit conditions.
 AHunt
 05/15/2026
 2:11:05 PM

City of Puyallup
 Planning Division
APPROVED
 See permit conditions.
 NComstock
 04/15/2026
 10:50:22 AM

City of Puyallup
 Building
REVIEWED FOR COMPLIANCE
 See permit conditions.
 BSnowden
 04/15/2026
 3:19:05 PM

The approved construction plans, documents, and all engineering must be posted on the job at all inspections in a visible and readily accessible location.

Full sized legible color plans are required to be provided by the permittee on site for inspection.

Approval of submitted plans is not an approval of omissions or oversights by this office or non-compliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable codes and regulations of the local government.

EXHIBIT D - SITE PLAN
NEW PROPANE DISPENSING STATION
 FOR THE SOUTH HILL TRANSPORTATION SITE
 PUYALLUP SCHOOL DISTRICT, NO. 3
 JANUARY 23, 2026

NORTH

HORIZONTAL SCALE: 1"=20'

20 0 20 40

DESIGNED: VMS
 DRAWN: VMS
 CHECKED: RCH
 DATE: 08/25/2020
 SCALE: AS NOTED

APPROVALS

SEAL

PREPARED BY: **SITTS & HILL ENGINEERS, INC.**
 CIVIL - STRUCTURAL - SURVEYING
 4815 CENTER STREET | TACOMA, WA 98409
 PHONE: (253) 474-9449 | FAX: (253) 474-0153
 http://www.sittshill.com/

PREPARED FOR: **PUYALLUP SCHOOL DISTRICT NO. 3**
 323 12TH ST NW
 PUYALLUP, WA 98371
 CONTACT: LES GERSTMANN

PROJECT: **SUPPORT CAMPUS BUS**
 1501 39TH AVENUE SW, PUYALLUP, WA

SHEET TITLE: **1**
 SHEET NO.: **1**
 PROJECT NO.: