

DDrake
05/29/2026
9:06:12 AM




Approval of submitted plans is not an approval of omissions or oversight by this office or noncompliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable building codes and regulations of the local government.

City of Puyallup
Development & Permitting Services
ISSUED PERMIT

Building	Planning
Engineering	Public Works
Fire	Traffic

**THE APPROVED CONSTRUCTION
PLANS AND ALL ENGINEERING
MUST BE POSTED ON THE JOB AT
ALL INSPECTIONS IN A VISIBLE AND
READILY ACCESSIBLE LOCATION.**

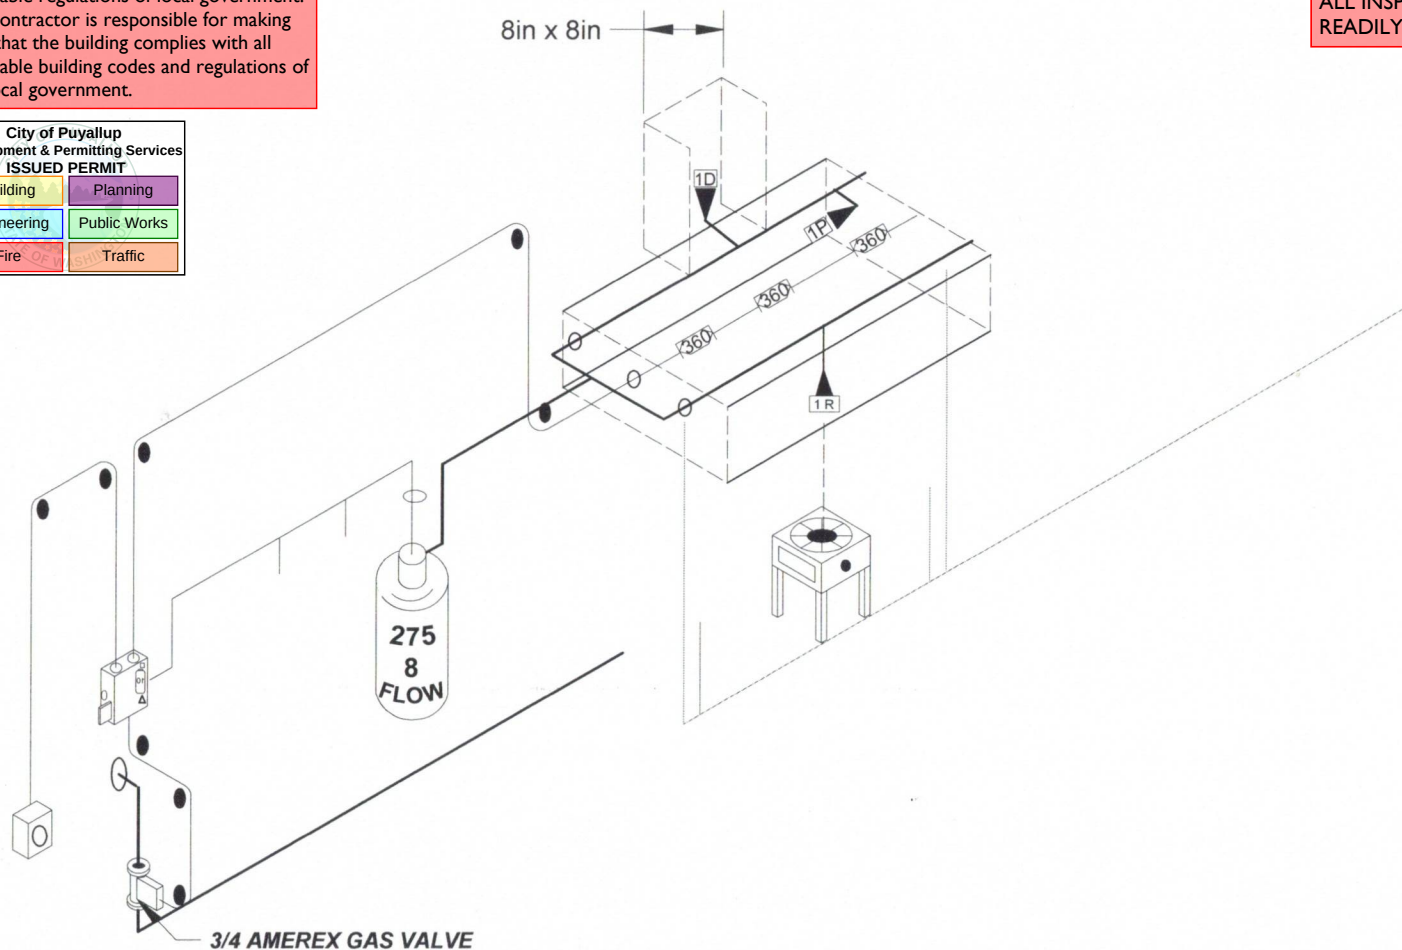

U.L. 300 Listed

NOZZLE BRANCH LINE LIMITATIONS:

ALL PIPE AND FITTINGS LEADING FROM THE SUPPLY BRANCH TEE TO A SYSTEM NOZZLE.

CYLINDER FLOW POINTS	PIPE SIZE	TOTAL LINEAR FEET OF PIPE	MAX. QTY. TEES	MAX. QTY. ELBOWS	MAX. QTY. BUSHINGS
KP275 = 8	3/8	32	5	10	0
KP375 = 11	3/8 OR 1/2	32	8	12	11
KP600 = 18	3/8	32	11	32	15
2-KP375 = 22	3/8	32	32	32	20
MAX. PER NOZZLE BRANCH		7	3	6	4



K CLASS EXTINGUISHER REQUIRED

PENINSULA FIRE INC
371 LINDVIG WAY NW SUITE 107
POULSBO WA 98370

LIC. # PENINF012B8

AMEREX CORPORATION			
DRAWN _____	DATE _____	DWG NUMBER 0000-0000	
Marcoe Candy Company 110 9th Ave S.W. Puyallup, WA 98371			
SCALE	1/4"=1'	REV	SHEET 1 OF 1