

**City of Puyallup
Fire
REVIEWED
FOR
COMPLIANCE**

DDrake
07/08/2026
9:47:13 PM




THE APPROVED CONSTRUCTION PLANS AND ALL ENGINEERING MUST BE POSTED ON THE JOB AT ALL INSPECTIONS IN A VISIBLE AND READILY ACCESSIBLE LOCATION.

Approval of submitted plans is not an approval of omissions or oversight by this office or noncompliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable building codes and regulations of the local government.

City of Puyallup Development & Permitting Services ISSUED PERMIT	
Building	Planning
Engineering	Public Works
Fire	Traffic

NOZZLE HEIGHT 42 IN
PIP SIZE
total flow point 7

Amerex kp KP275 suppression system ul 300

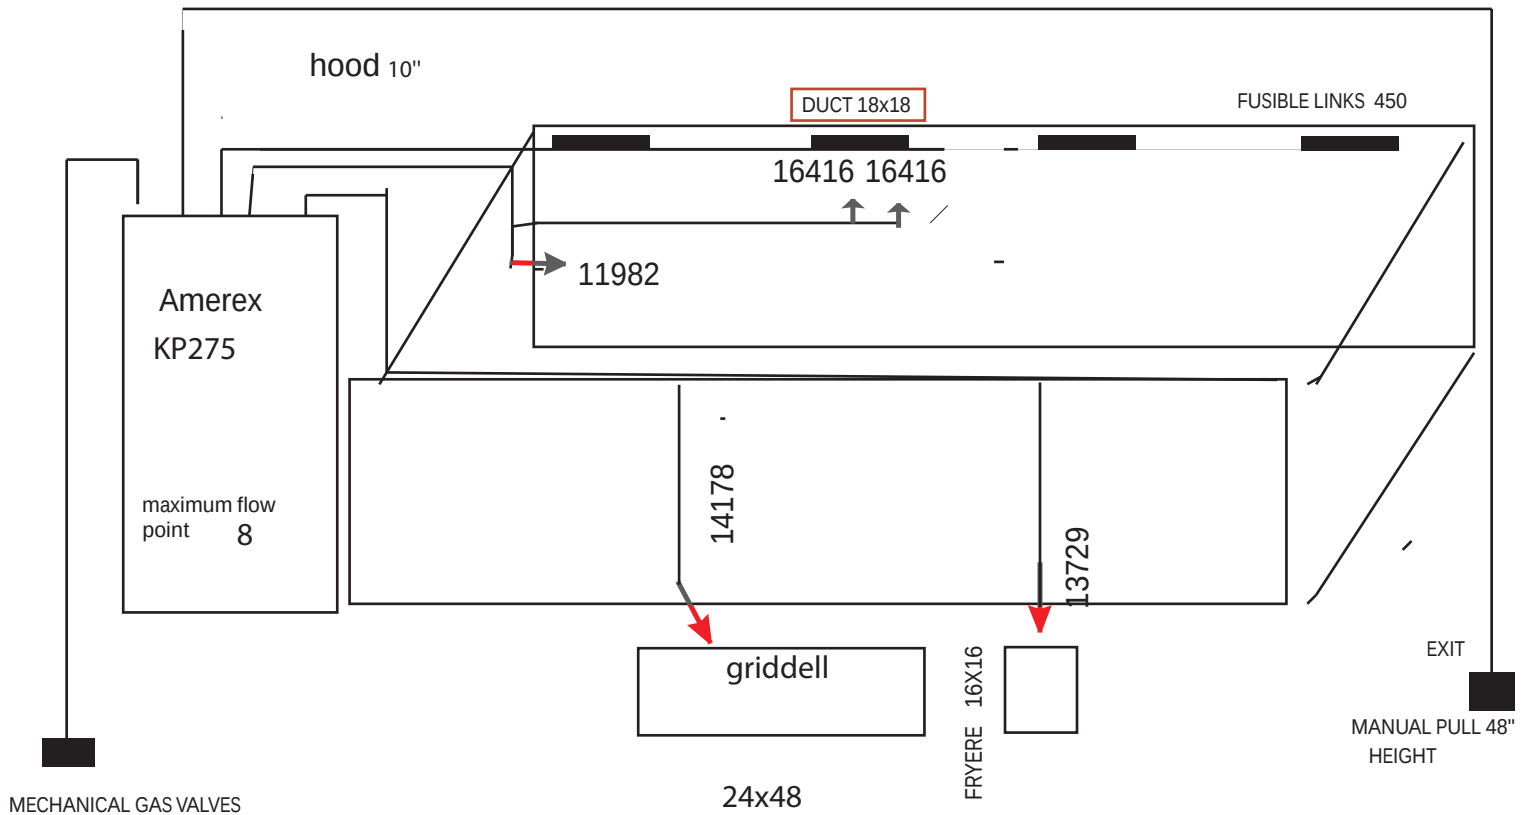

All cooking equipment under the hood shall shut off when system is actuated & make up air unit and gas shut valve to fire suppression system shall be connected to the fire alarm system

K CLASS FIRE EXTI

Installed by Frank fire portection inc 206 229 5245