

Approval of submitted plans is not an approval of omissions or oversights by this office or non compliance with any applicable regulations of local government. The contractor is responsible for making sure that the building complies with all applicable codes and regulations of the local government.

The approved construction plans, documents, and all engineering must be posted on the job at all inspections in a visible and readily accessible location.

Full sized legible color plans are required to be provided by the permittee on site for inspection.


Separate Electrical Permit is required with the Washington State Department of Labor & Industries.
<https://lni.wa.gov/licensing-permits/electrical/electrical-permits-fees-and-inspections>
or call for Licensing Information: 1-800-647-0982

CONTRACTOR NOTE


2021 Washington State Fuel and Gas Code, Section 408.4

Where a sediment trap is not incorporated as part of the appliance, a sediment trap shall be installed downstream of the appliance shutoff valve as close to the inlet of the appliance as practical. The sediment trap shall be either a tee fitting having a capped nipple of any length installed vertically in the bottommost opening of the tee.

PRMH20260943



INTALL GAS PIPING FROM THE METER
TO RANGE AND Griddle 1 1/2 "

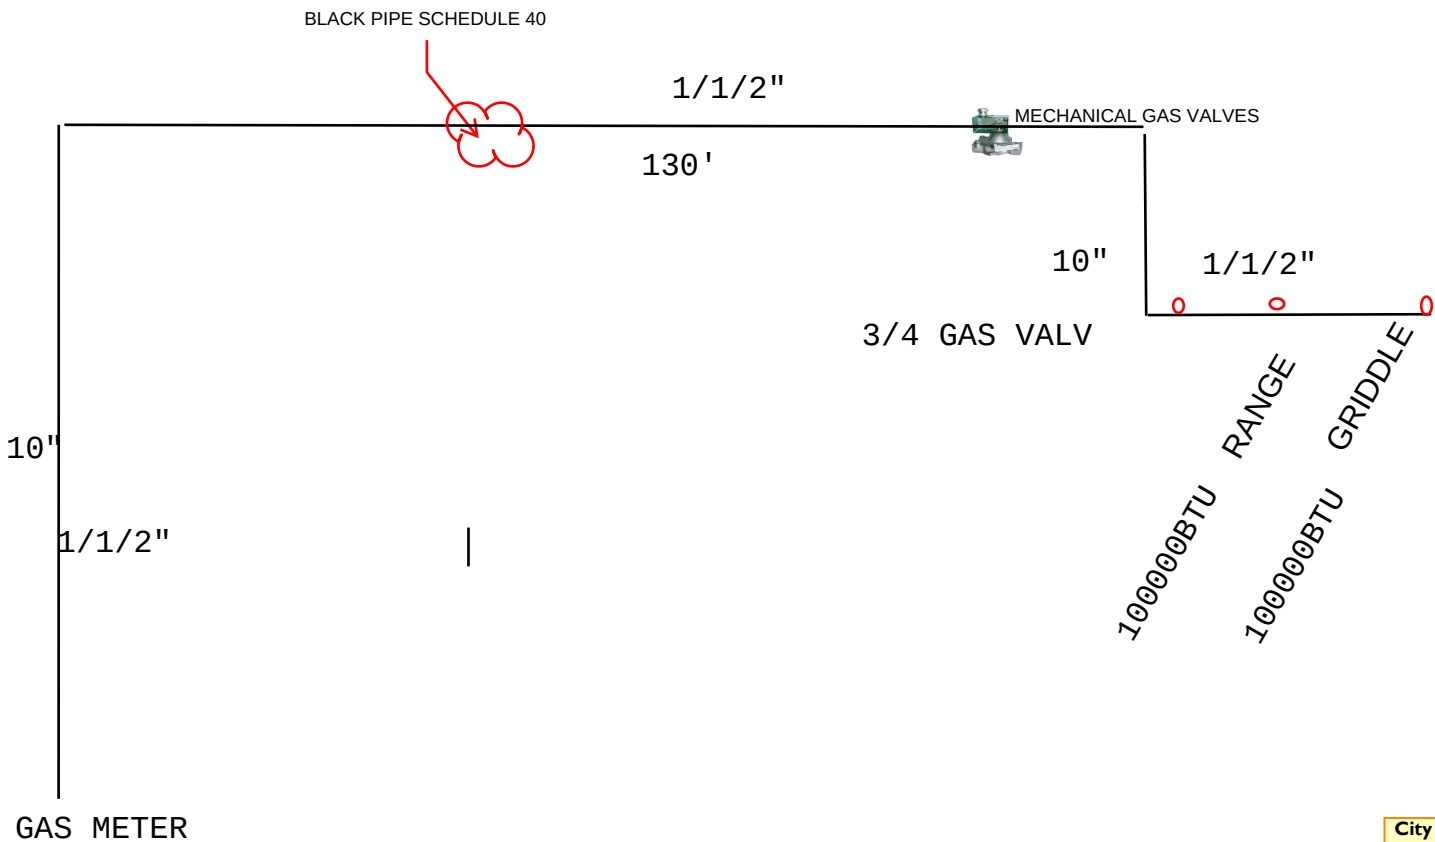

0.5 WC PRESSURE DROP

Installed by Frank Fire Protection
Phone: (206) 229-5245
Email: franksourish@yahoo.com

City of Puyallup
Building
REVIEWED
FOR
COMPLIANCE

SKinnear
07/09/2026
8:44:48 AM

