

CITY OF PUYALLUP

PIERCE COUNTY

WASHINGTON



WATER POLLUTION CONTROL PLANT THIRD SECONDARY CLARIFIER CIP NO. 20-018

CITY OF PUYALLUP
DEPARTMENT OF PUBLIC WORKS
1100 39TH AVENUE SE
PUYALLUP, WASHINGTON 98371


CONTACT PERSONNEL

<u>NAME</u>	<u>AGENCY</u>	<u>PHONE NO.</u>
DANIEL MESSIER	WPCP MANAGER	253-453-3658
MAREK BARTYZEL	WPCP OPERATIONS AND MAINTENANCE SUPERVISOR	253-841-5467
SCOTT TKACH, P.E.	CIP ENGINEER	253-841-5463
HANS HUNGER, P.E.	CITY ENGINEER	253-841-5499



1130 RAINIER AVENUE SOUTH, SUITE 300
SEATTLE, WASHINGTON 98144
(206) 284-0860


DECEMBER 2021
G&O JOB #21462.00

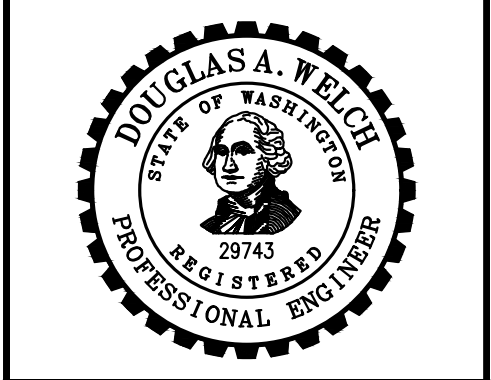

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
 1602 18TH ST NW,
 PUYALLUP, WA 98371

PRELIMINARY
NOT FOR
CONSTRUCTION

No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: DAW		
CHECKED BY: KPS		
DRAWN BY: CRR		
DESIGNER: DAW		
G & O JOB NO.: 21462		
FILE: G_MAPS-INDEX.DWG		



GENERAL

APPROVED

BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP

APPROVED
 DATE: _____
 EXPIRATION
 DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans.

Field conditions may dictate changes to these plans as determined by the City Engineer.


**VICINITY MAP,
 LOCATION MAP AND
 SHEET INDEX**

DRAWING: **G-1** OF: **8**


SHEET INDEX

SHEET NO. DESCRIPTION

GENERAL	
--	COVER
G-1	VICINITY MAP, LOCATION MAP AND SHEET INDEX
G-2	PLANT DESIGN CRITERIA
G-3	ABBREVIATIONS, GENERAL SYMBOLS, SYMBOL LEGEND, NUMBERING SYSTEM AND GENERAL NOTES
G-4	PROCESS FLOW DIAGRAM
G-5	HYDRAULIC PROFILE
G-6	EXISTING SITE PLAN
G-7	NEW SITE PLAN AND AREA IDENTIFICATION
G-8	SITE PIPING PLAN
GENERAL DETAILS	
GD-1	TESC NOTES AND DETAILS
GD-2	GENERAL DETAILS
GD-3	WASHWATER DETAILS
MECHANICAL	
M-1	ABBREVIATIONS, SYMBOLS AND EQUIPMENT IDENTIFICATIONS
M-2	PIPE DETAILS
M-3	MISCELLANEOUS DETAILS
M-4	MISCELLANEOUS DETAILS
M6-1	SECONDARY CLARIFIER SPLITTER BOX AND RAS/WAS PUMP STATION PLAN
M6-2	SECONDARY CLARIFIER SPLITTER BOX AND RAS/WAS PUMP STATION SECTIONS
M6-3	SECONDARY CLARIFIER SPLITTER BOX AND RAS/WAS PUMP STATION SECTIONS AND DETAILS
M7-1	SECONDARY CLARIFIER NO. 3 PLAN
M7-2	SECONDARY CLARIFIER NO. 3 SECTIONS
M7-3	SECONDARY CLARIFIER NO. 3 SECTIONS AND DETAILS
M7-4	EXISTING EFFLUENT FLOWMETER MANHOLE DEMOLITION PLAN
M7-5	SECONDARY CLARIFIER NO. 3 SCUM PUMP STATION
M8-1	EFFLUENT FLOW METER PLAN AND SECTION
ARCHITECTURAL	
A6-1	RAS/WAS PUMP STATION NOTES, DETAILS, AND PLANS
HVAC	
H6-1	NOTES AND ABBREVIATIONS
H6-2	EQUIPMENT SCHEDULES
H6-3	DEMOLITION AND PROPOSED PLANS
PLUMBING	
P6-1	PLUMBING NOTES, LEGEND AND DETAILS
P6-2	SECONDARY SPLITTER BOX AND RAS/WAS PUMP STATION PLAN AND DETAILS
STRUCTURAL	
S-1	
S-2	SPECIAL INSPECTION SCHEDULE, SUPPLEMENTAL STRUCTURAL ABBREVIATIONS, STRUCTURAL LEGEND AND TYPICAL DETAILS
S-3	TYPICAL STRUCTURAL DETAILS
S7-1	SECONDARY CLARIFIER NO. 3 TEMPORARY SHORING/GROUND FREEZE PLAN
S7-2	SECONDARY CLARIFIER NO. 3 FOUNDATION PLAN AND DETAIL
S7-3	SECONDARY CLARIFIER NO. 3 UPPER PLAN
S7-4	SECONDARY CLARIFIER NO. 3 SECTION AND DETAILS
ELECTRICAL	
E-1	
E-2	MCC ELEVATIONS AND SCHEDULES
E-3	EXISTING VFD E.W.D.S
E-4	ONE LINE DIAGRAMS AND E.W.D.S.
E-5	PLC CONTROL SYSTEM MODIFICATIONS
E-6	ELECTRICAL DETAILS
E-7	SCUM PUMP CONTROL PANEL NO. 2 DETAILS
E6-1	DEMO AND MODIFIED RAS/WAS BUILDING - MAIN LEVEL
E6-2	EXIST/MODIFIED RAS/WAS BUILDING - LOWER LEVEL
E7-1	ELECTRICAL PLAN CLARIFIER NO. 3
E7-2	ELECTRICAL PLAN EXISTING CLARIFIERS
E8-1	ELECTRICAL PLAN EFFLUENT FLOWMETER

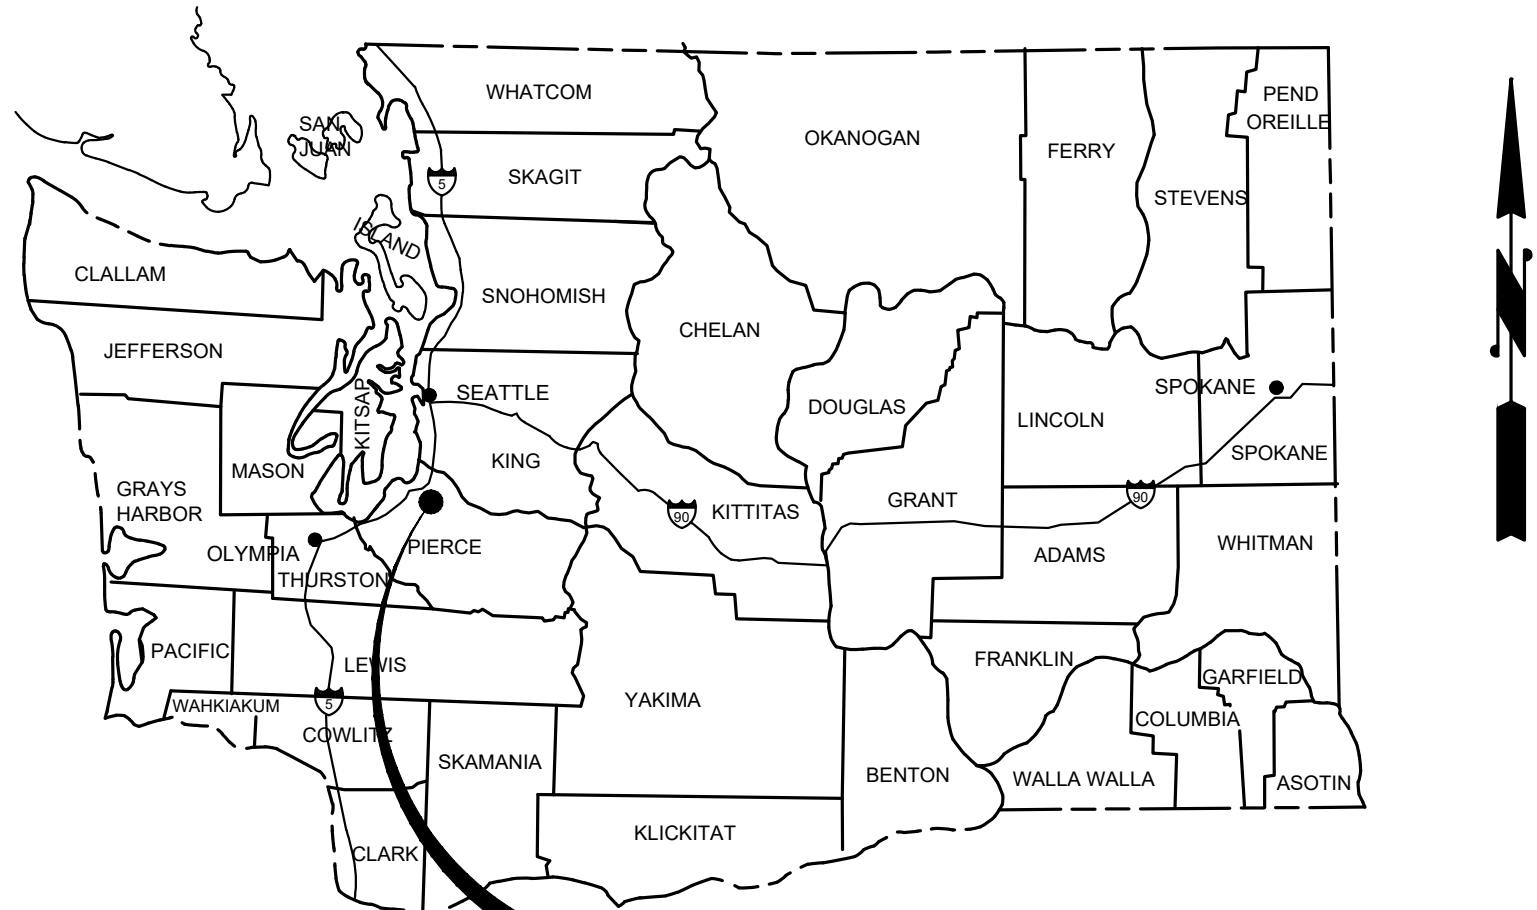


PUYALLUP WPCP
VICINITY MAP
 NOT TO SCALE

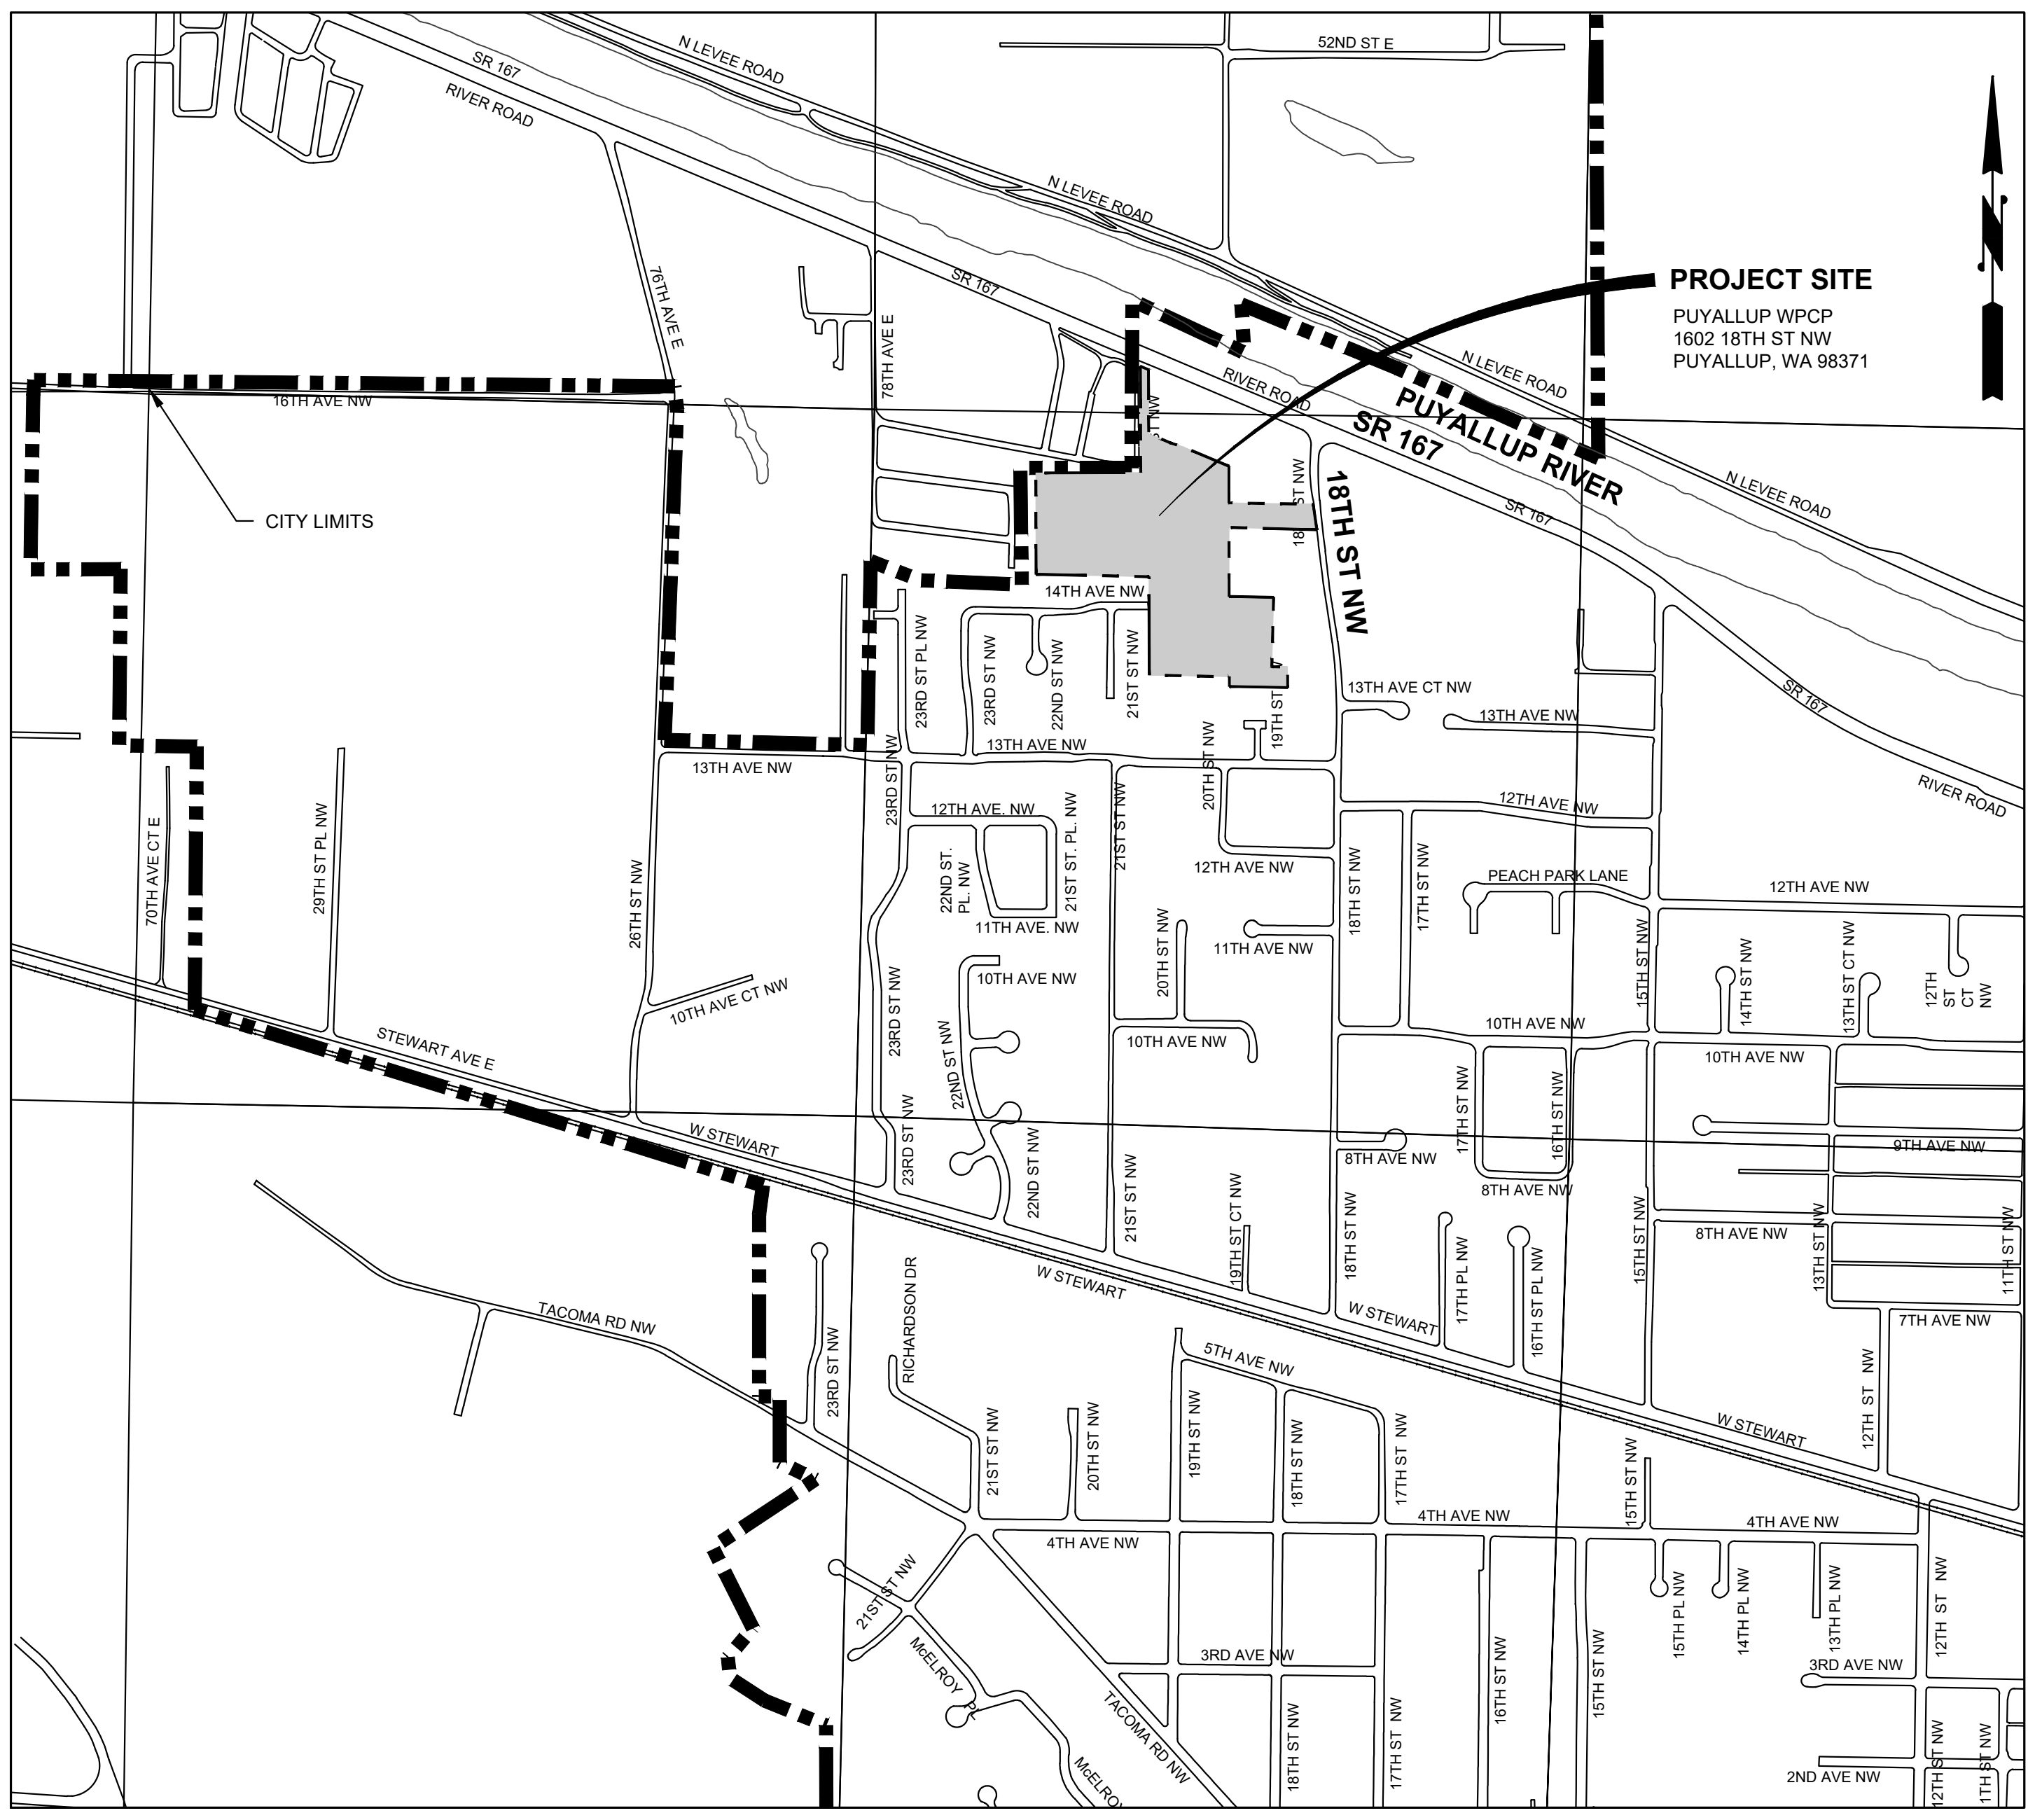

LOCATION MAP
 SCALE: 1"=500'-0"


M:\PUYALLUP\21462 wpcp 3rd secondary clarifier\01 design\plans\set\General\G_MAPS-INDEX.dwg, 1/3/2022 3:10 PM, CHARLEY REID

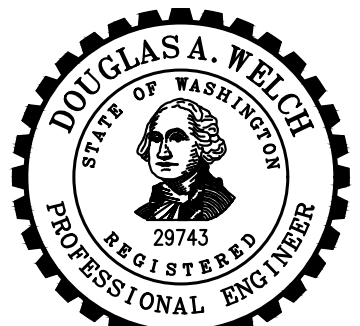

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
 1602 18TH ST NW,
 PUYALLUP, WA 98371

PRELIMINARY
NOT FOR
CONSTRUCTION

No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: DAW		
CHECKED BY: KPS		
DRAWN BY: CRR		
DESIGNER: DAW		
G & O JOB NO.: 21462		
FILE: G_PFD.DWG		



GENERAL

APPROVED

BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP

APPROVED
 DATE: _____

EXPIRATION
 DATE: _____


NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans.

Field conditions may dictate changes to these plans as determined by the City Engineer.



PROCESS FLOW DIAGRAM

DRAWING: **G-4** OF: **8**

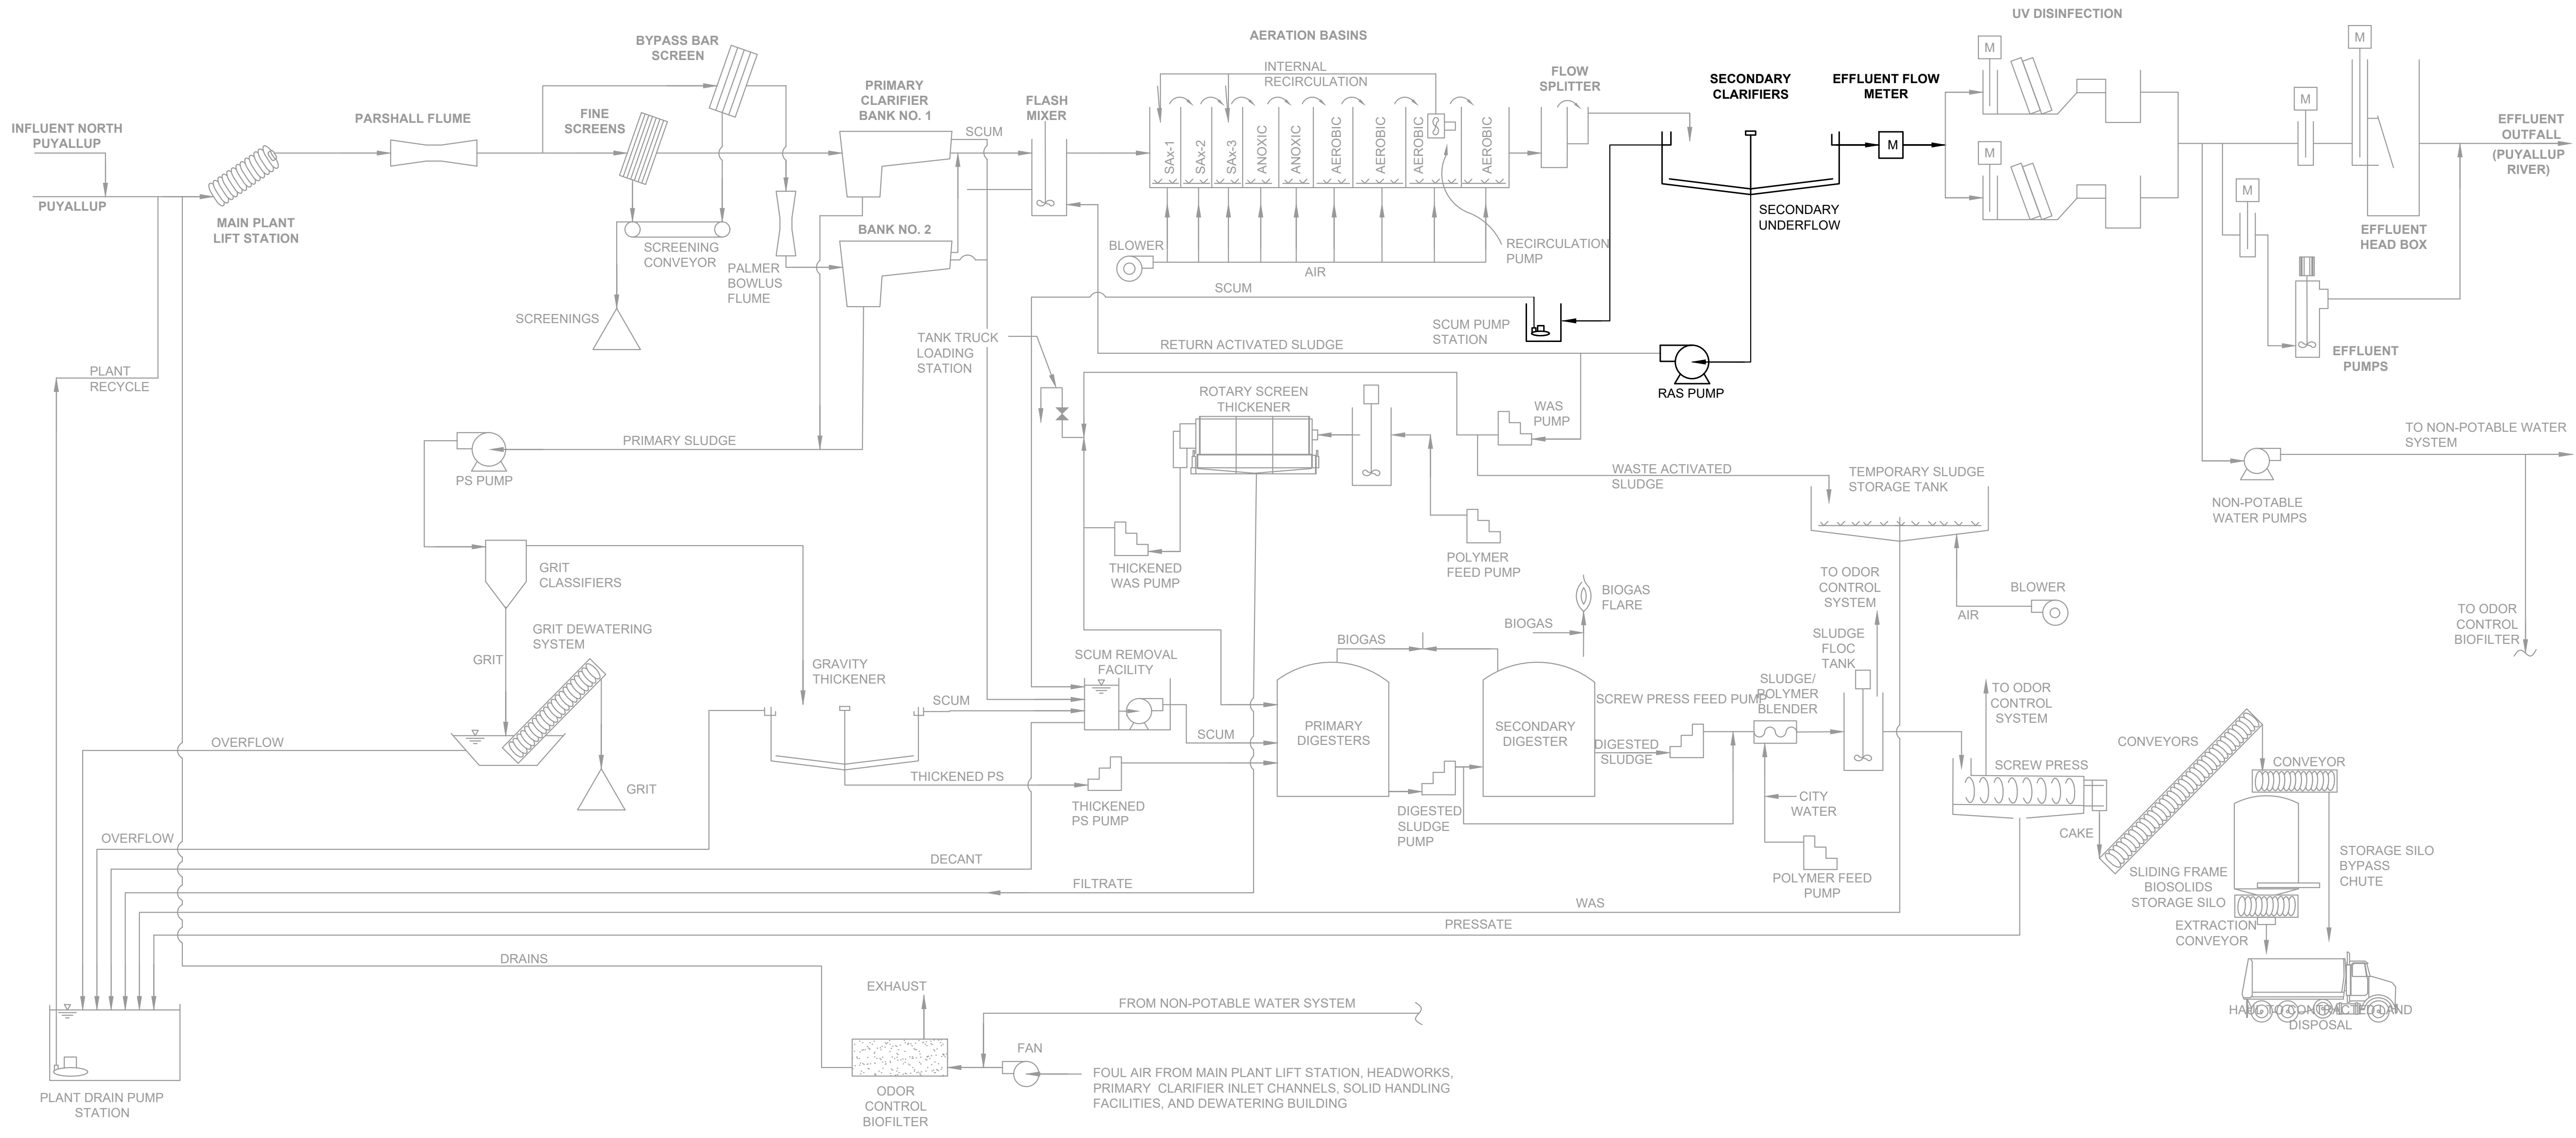


PROCESS FLOW DIAGRAM

m:\PUYALLUP\21462 wpcp 3rd secondary clarifier\01 design\PlanSet\General\G_PFD.dwg, 1/3/2022 1:11 PM, CHARLEY REID

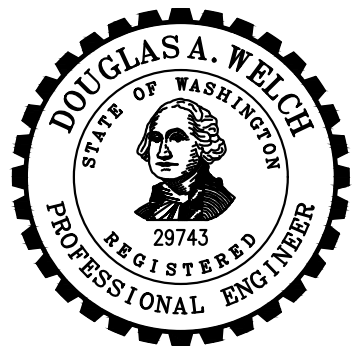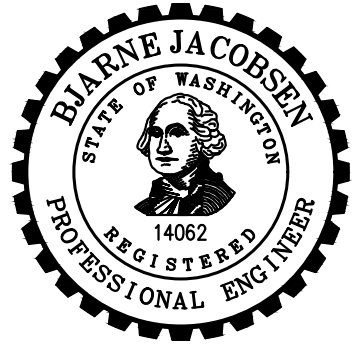

PRELIMINARY
NOT FOR
CONSTRUCTION

No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: DAW		
CHECKED BY: KPS		
DRAWN BY: CRR		
DESIGNER: DAW		
G & O JOB NO.: 21462		
FILE: G_HYD-PRO.DWG		



GENERAL

APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP



APPROVED
DATE: _____
EXPIRATION
DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans.

Field conditions may dictate changes to these plans as determined by the City Engineer.


HYDRAULIC PROFILE

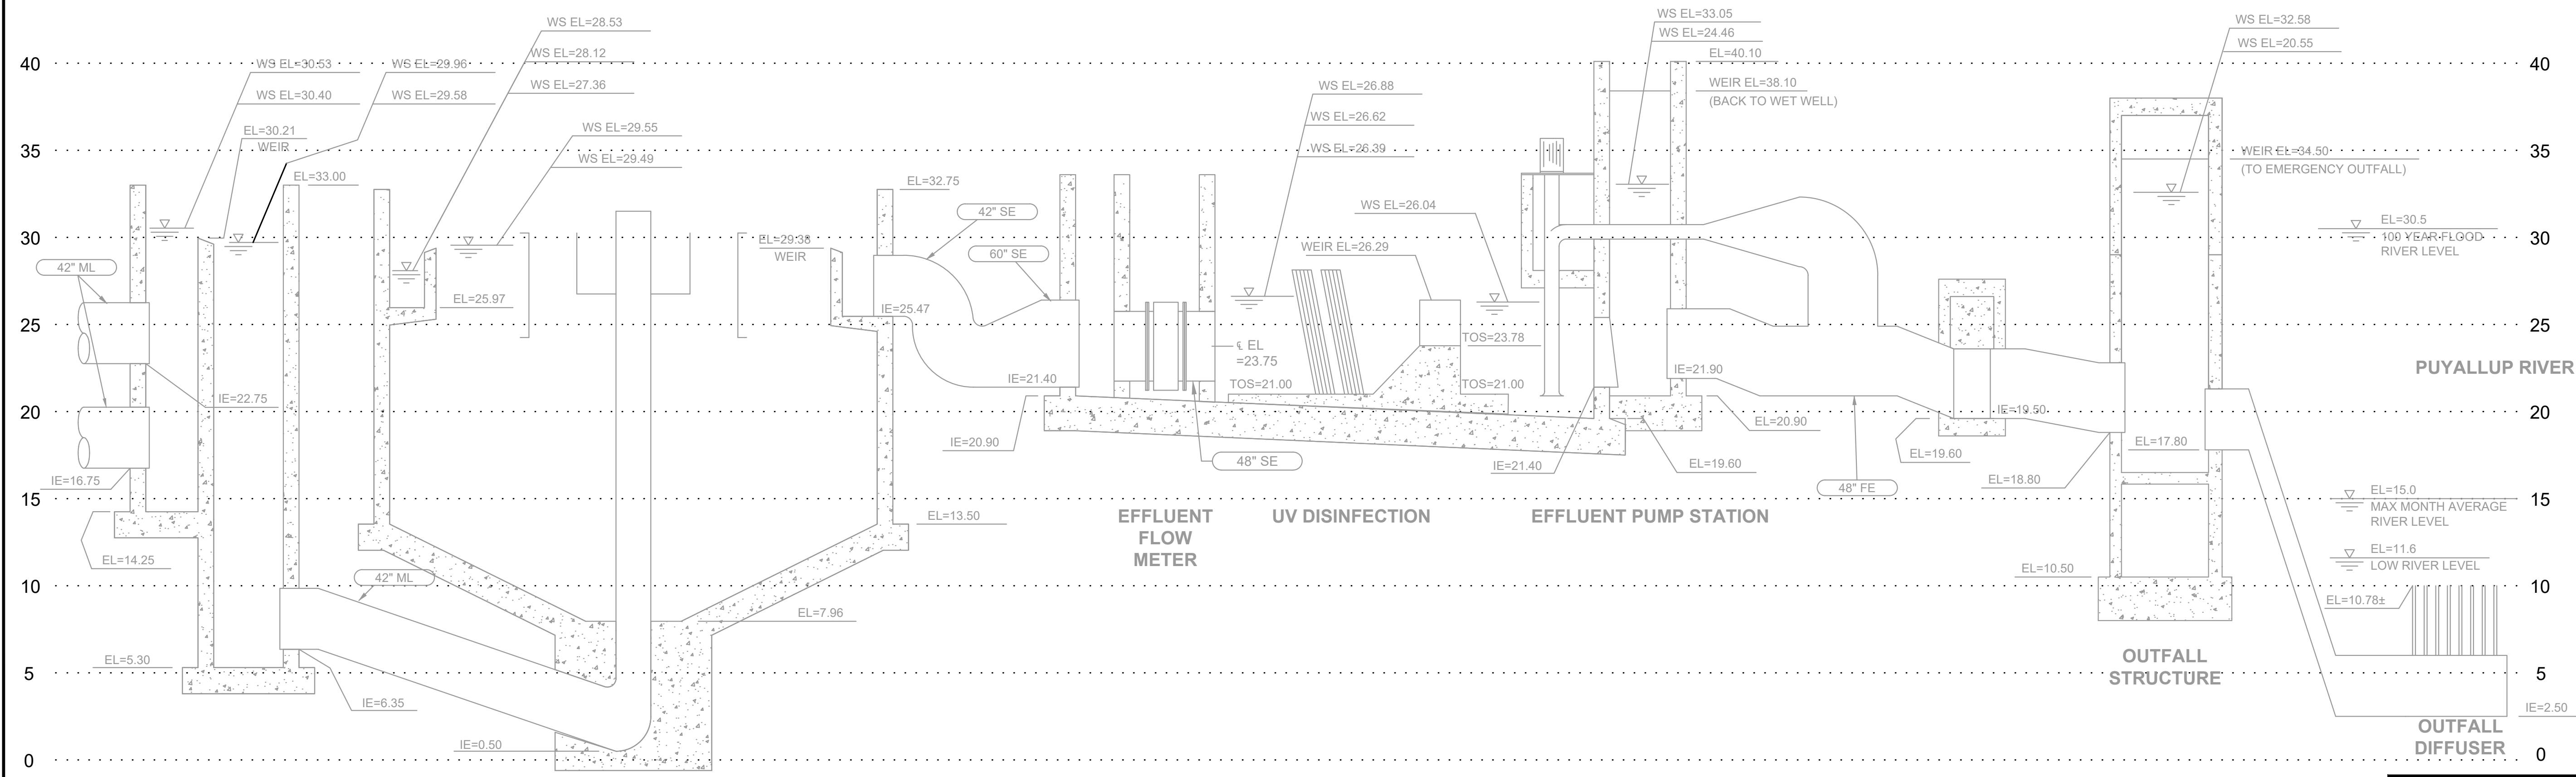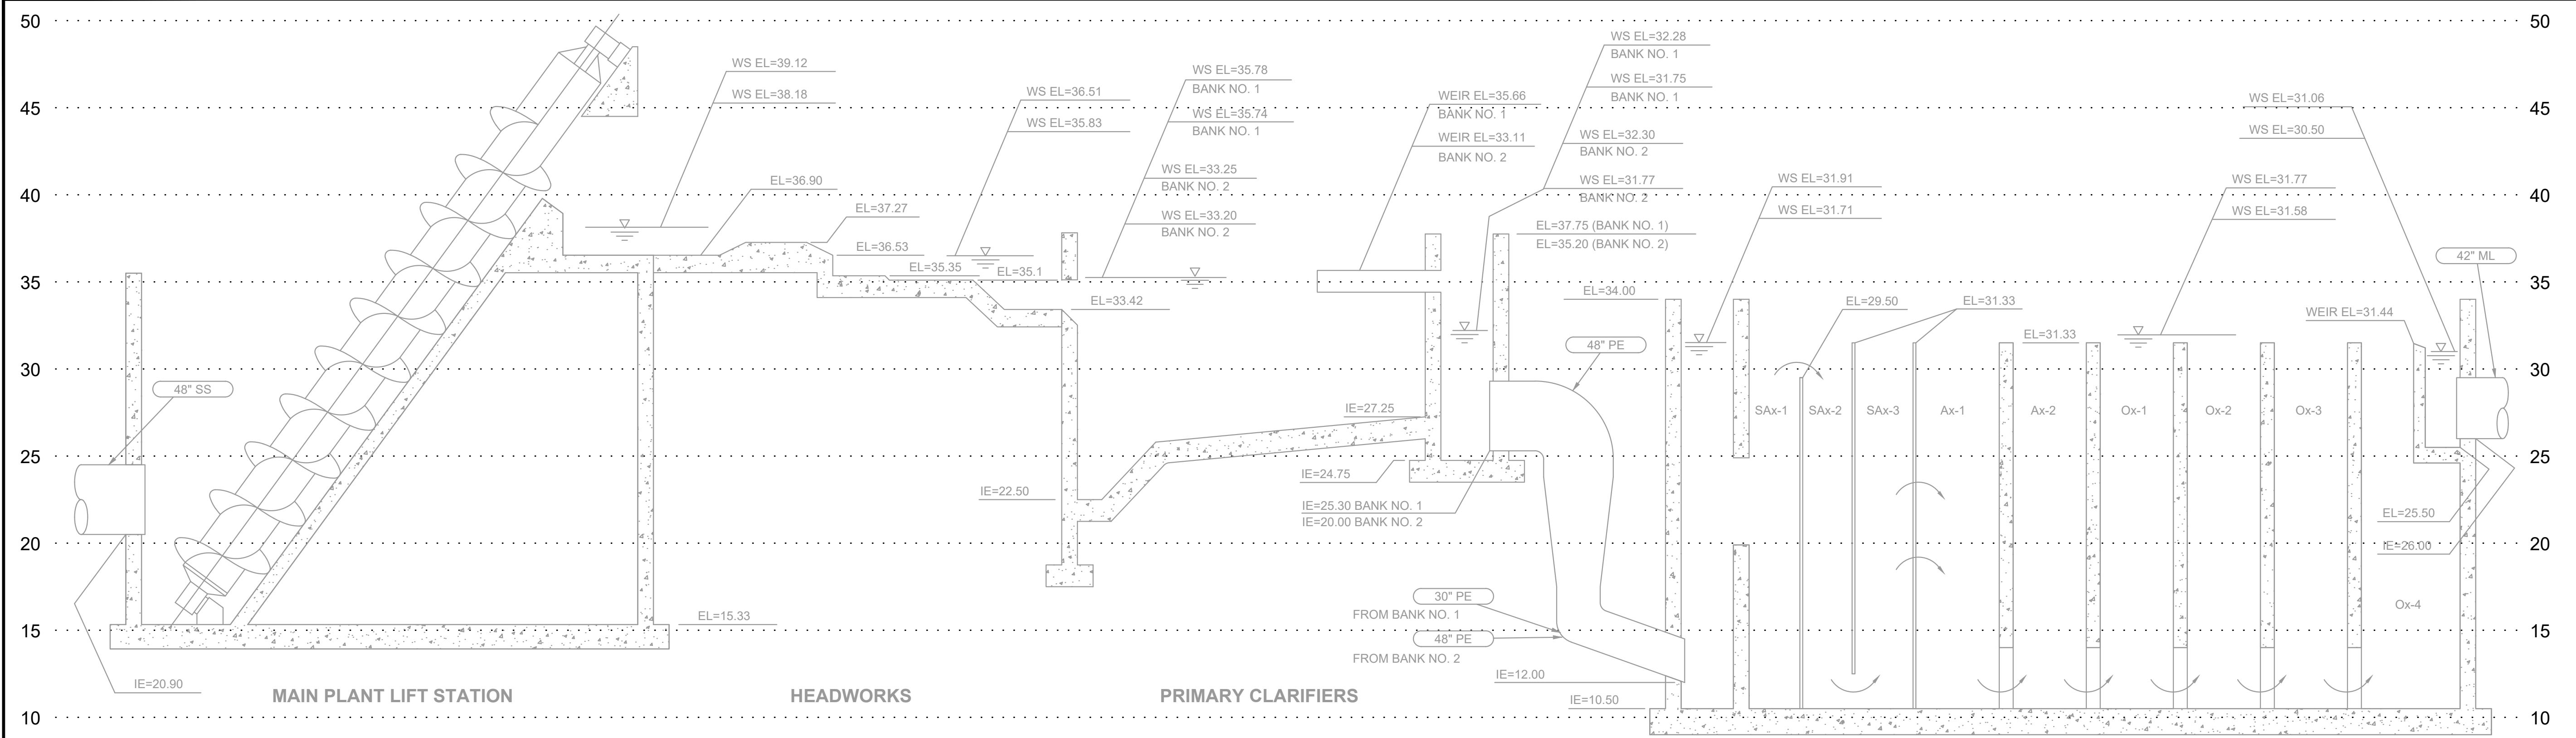



WS EL @ PROJECT 20 YEAR PEAK HOUR FLOW (39.30 MGD +0.65 MGD NPW FLOW)
WS EL @ CURRENT PEAK HOUR FLOW (27.38 MGD +0.65 MGD NPW FLOW)
WS EL @ CURRENT MAXIMUM MONTH FLOW (13.98 MGD +0.36 MGD NPW FLOW)

HYDRAULIC PROFILE
SCALE: VERTICAL 1"=5'-0"
HORIZONTAL NOT TO SCALE

m:\PUYALLUP\21462 wpcp 3rd secondary clarifier\01 design\plan\set\General\IG_HYD-PRO.dwg, 1/3/2022 1:11 PM, CHARLEY REID

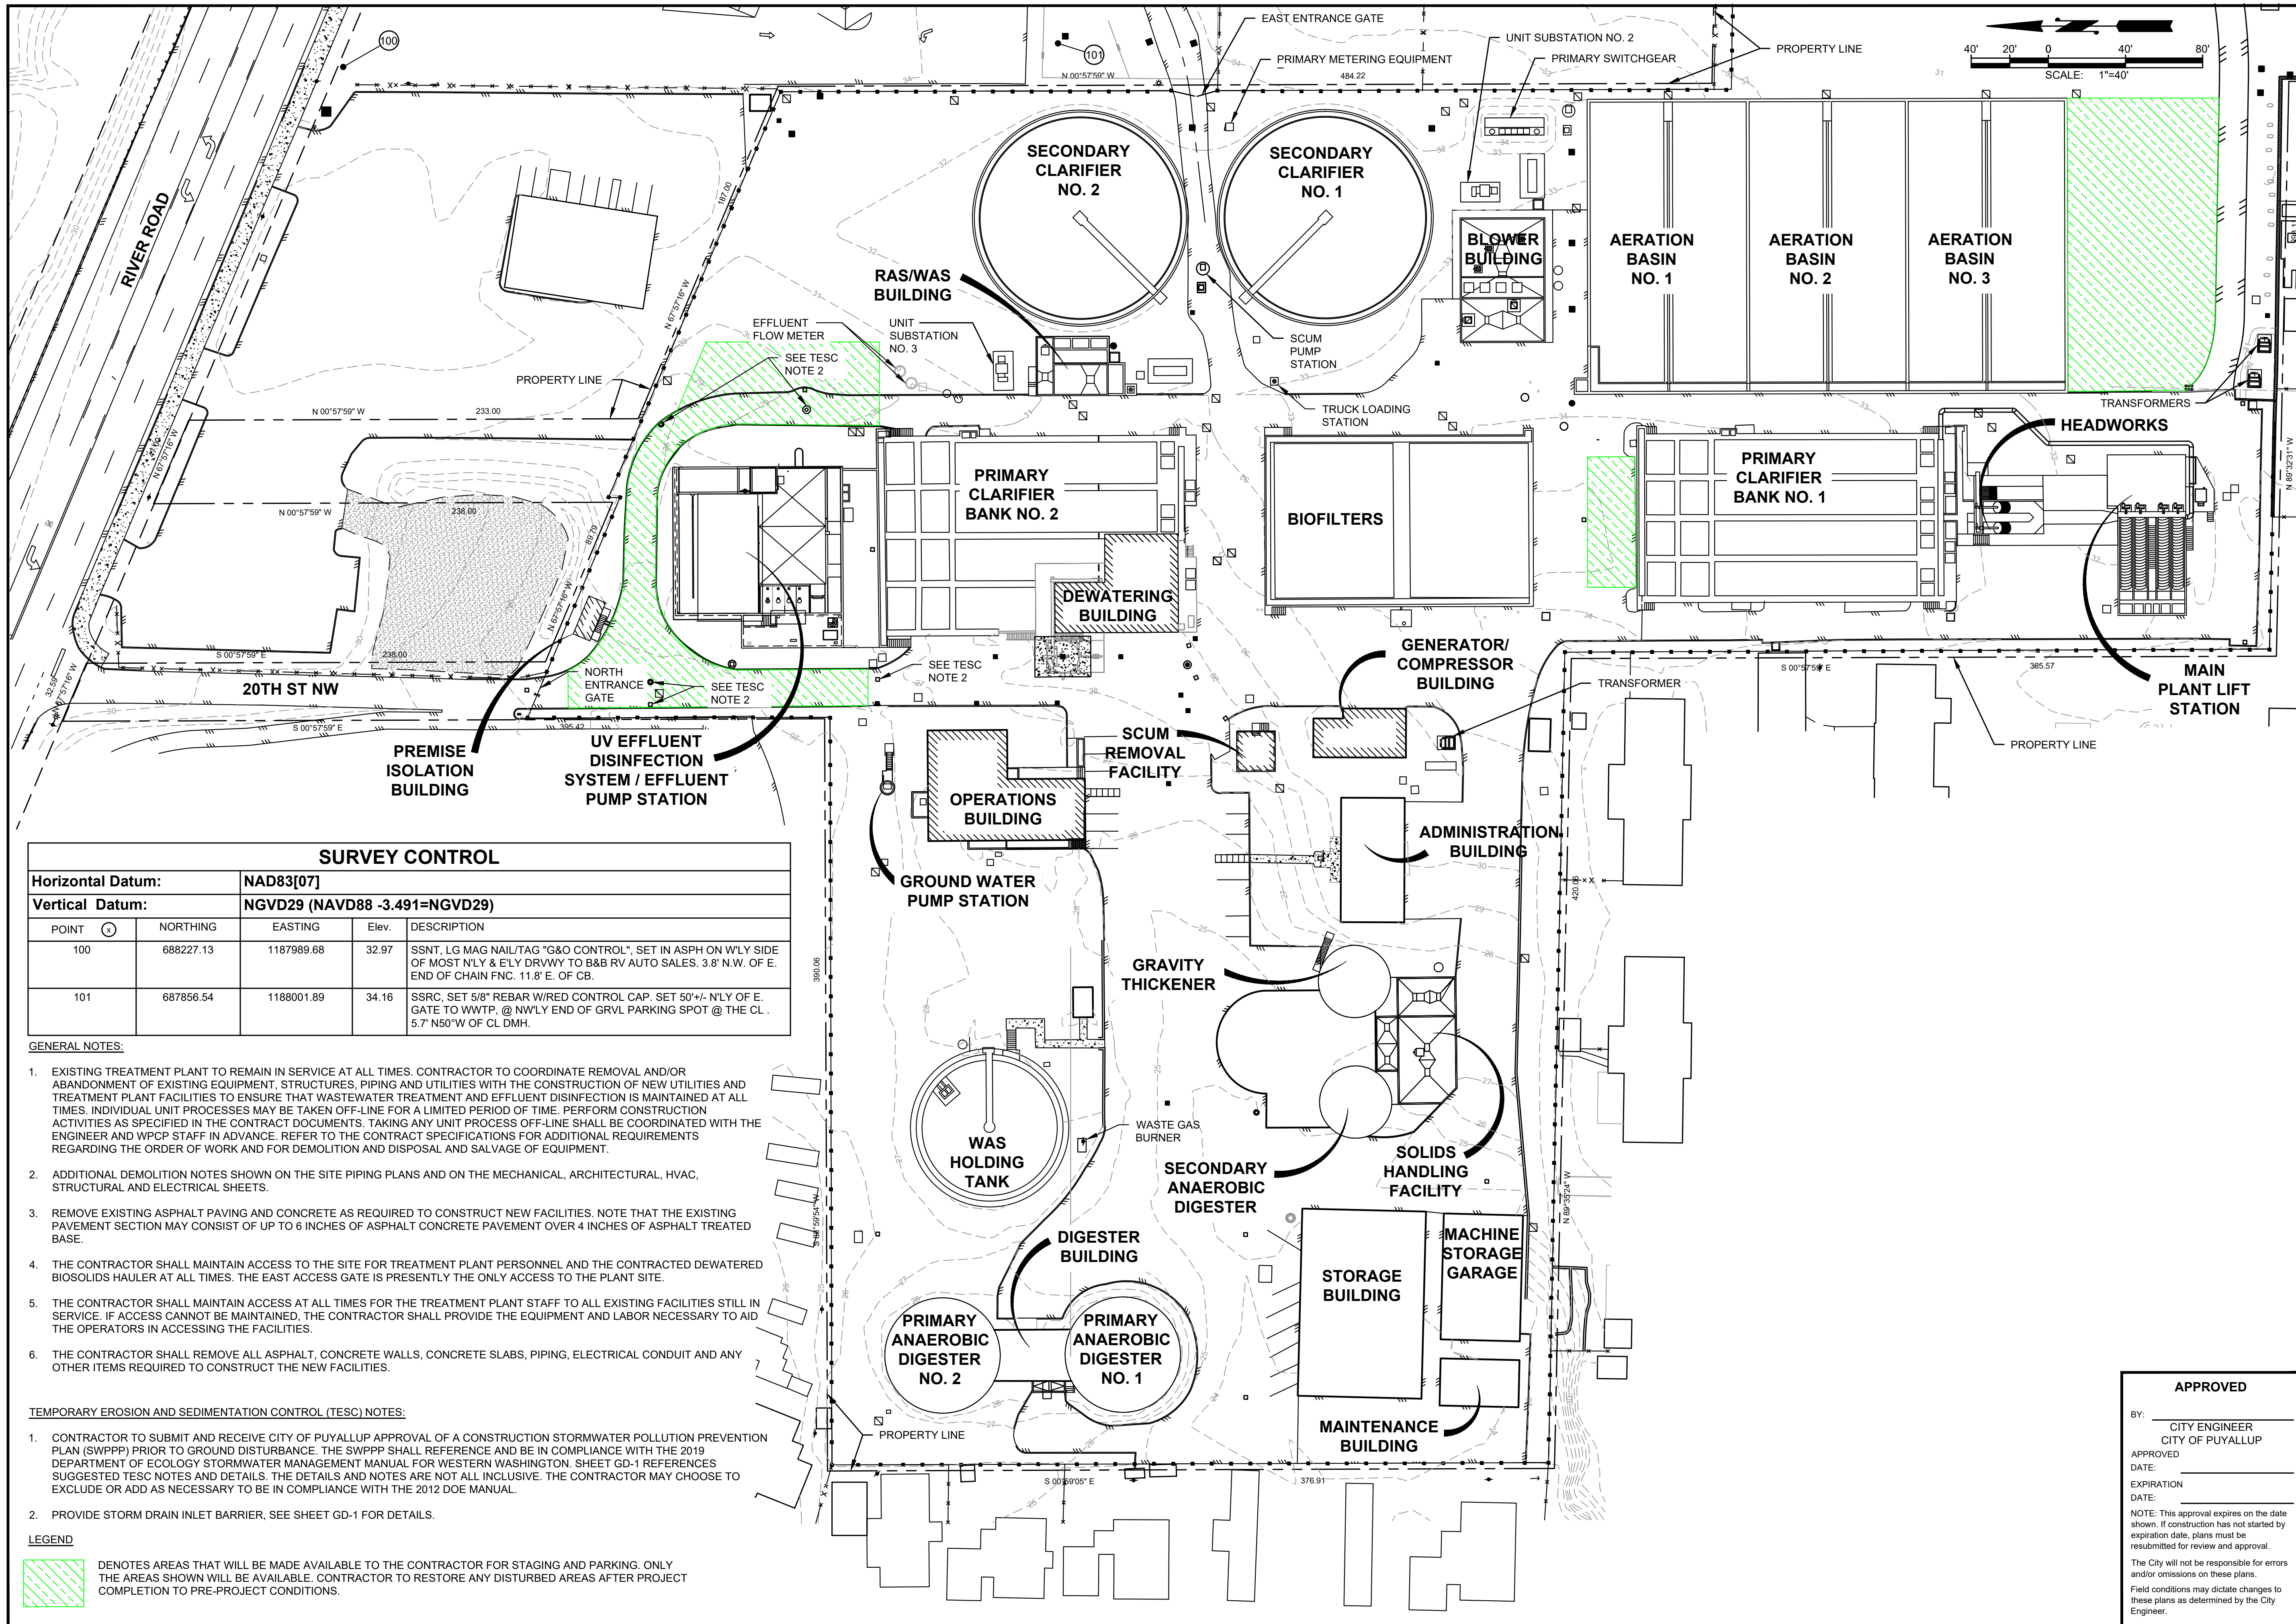


Gray & Osborne, Inc.
 CONSULTING ENGINEERS
 1130 RAINIER AVENUE SOUTH,
 SUITE 300
 SEATTLE, WASHINGTON 98144
 (206) 284-0860

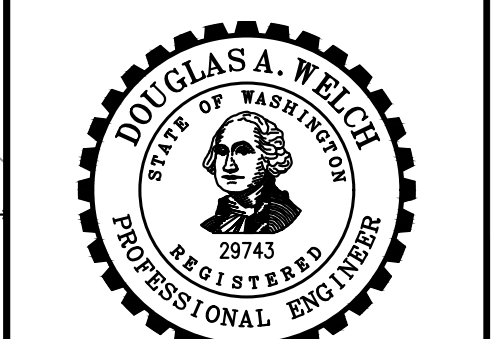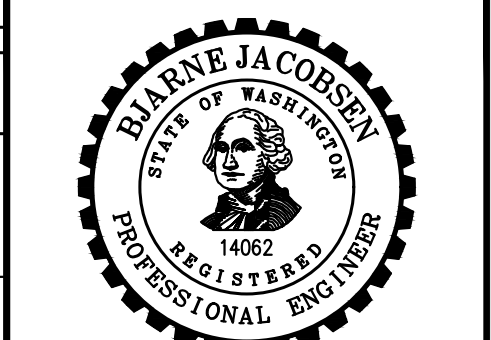

CITY OF PUYALLUP
 WATER POLLUTION
 CONTROL PLANT THIRD
 SECONDARY CLARIFIER
 CIP NO. 20-018
 1602 18TH ST NW,
 PUYALLUP, WA 98371

**PRELIMINARY
 NOT FOR
 CONSTRUCTION**

No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: DAW		
CHECKED BY: KPS		
DRAWN BY: CRR		
DESIGNER: DAW		
G & O JOB NO.: 21462		
FILE: G_SITE_EX.DWG		



GENERAL

APPROVED
 BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP
 APPROVED
 DATE: _____
 EXPIRATION
 DATE: _____
 NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
 The City will not be responsible for errors and/or omissions on these plans.
 Field conditions may dictate changes to these plans as determined by the City Engineer.

EXISTING SITE PLAN

DRAWING: **G-6** OF: **8**

SURVEY CONTROL				
Horizontal Datum:	NAD83[07]			
Vertical Datum:	NGVD29 (NAVD88 -3.491=NGVD29)			
POINT	NORTHING	EASTING	Elev.	DESCRIPTION
100	688227.13	1187989.68	32.97	SSNT, LG MAG NAILTAG "G&O CONTROL" SET IN ASPH ON W'LY SIDE OF MOST N'LY & E'LY DRVWY TO B&B RV AUTO SALES. 3.8' N.W. OF E. END OF CHAIN FNC. 11.8' E. OF CB.
101	687856.54	1188001.89	34.16	SSRC, SET 5/8" REBAR W/RED CONTROL CAP. SET 50'+/- N'LY OF E. GATE TO WWTP. @ NW'LY END OF GRVL PARKING SPOT @ THE CL. 5.7' N50°W OF CL DMH.

- GENERAL NOTES:**
- EXISTING TREATMENT PLANT TO REMAIN IN SERVICE AT ALL TIMES. CONTRACTOR TO COORDINATE REMOVAL AND/OR ABANDONMENT OF EXISTING EQUIPMENT, STRUCTURES, PIPING AND UTILITIES WITH THE CONSTRUCTION OF NEW UTILITIES AND TREATMENT PLANT FACILITIES TO ENSURE THAT WASTEWATER TREATMENT AND EFFLUENT DISINFECTION IS MAINTAINED AT ALL TIMES. INDIVIDUAL UNIT PROCESSES MAY BE TAKEN OFF-LINE FOR A LIMITED PERIOD OF TIME. PERFORM CONSTRUCTION ACTIVITIES AS SPECIFIED IN THE CONTRACT DOCUMENTS. TAKING ANY UNIT PROCESS OFF-LINE SHALL BE COORDINATED WITH THE ENGINEER AND WPCP STAFF IN ADVANCE. REFER TO THE CONTRACT SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS REGARDING THE ORDER OF WORK AND FOR DEMOLITION AND DISPOSAL AND SALVAGE OF EQUIPMENT.
 - ADDITIONAL DEMOLITION NOTES SHOWN ON THE SITE PIPING PLANS AND ON THE MECHANICAL, ARCHITECTURAL, HVAC, STRUCTURAL AND ELECTRICAL SHEETS.
 - REMOVE EXISTING ASPHALT PAVING AND CONCRETE AS REQUIRED TO CONSTRUCT NEW FACILITIES. NOTE THAT THE EXISTING PAVEMENT SECTION MAY CONSIST OF UP TO 6 INCHES OF ASPHALT CONCRETE PAVEMENT OVER 4 INCHES OF ASPHALT TREATED BASE.
 - THE CONTRACTOR SHALL MAINTAIN ACCESS TO THE SITE FOR TREATMENT PLANT PERSONNEL AND THE CONTRACTED DEWATERED BIOSOLIDS HAULER AT ALL TIMES. THE EAST ACCESS GATE IS PRESENTLY THE ONLY ACCESS TO THE PLANT SITE.
 - THE CONTRACTOR SHALL MAINTAIN ACCESS AT ALL TIMES FOR THE TREATMENT PLANT STAFF TO ALL EXISTING FACILITIES STILL IN SERVICE. IF ACCESS CANNOT BE MAINTAINED, THE CONTRACTOR SHALL PROVIDE THE EQUIPMENT AND LABOR NECESSARY TO AID THE OPERATORS IN ACCESSING THE FACILITIES.
 - THE CONTRACTOR SHALL REMOVE ALL ASPHALT, CONCRETE WALLS, CONCRETE SLABS, PIPING, ELECTRICAL CONDUIT AND ANY OTHER ITEMS REQUIRED TO CONSTRUCT THE NEW FACILITIES.


- TEMPORARY EROSION AND SEDIMENTATION CONTROL (TESC) NOTES:**
- CONTRACTOR TO SUBMIT AND RECEIVE CITY OF PUYALLUP APPROVAL OF A CONSTRUCTION STORMWATER POLLUTION PREVENTION PLAN (SWPPP) PRIOR TO GROUND DISTURBANCE. THE SWPPP SHALL REFERENCE AND BE IN COMPLIANCE WITH THE 2019 DEPARTMENT OF ECOLOGY STORMWATER MANAGEMENT MANUAL FOR WESTERN WASHINGTON. SHEET GD-1 REFERENCES SUGGESTED TESC NOTES AND DETAILS. THE DETAILS AND NOTES ARE NOT ALL INCLUSIVE. THE CONTRACTOR MAY CHOOSE TO EXCLUDE OR ADD AS NECESSARY TO BE IN COMPLIANCE WITH THE 2012 DOE MANUAL.
 - PROVIDE STORM DRAIN INLET BARRIER, SEE SHEET GD-1 FOR DETAILS.

LEGEND

DENOTES AREAS THAT WILL BE MADE AVAILABLE TO THE CONTRACTOR FOR STAGING AND PARKING. ONLY THE AREAS SHOWN WILL BE AVAILABLE. CONTRACTOR TO RESTORE ANY DISTURBED AREAS AFTER PROJECT COMPLETION TO PRE-PROJECT CONDITIONS.

m:\PUYALLUP\21462 wpcp 3rd secondary clarifier\01 design\plans\set\General\G_SITE_EX.dwg, 1/3/2022 1:12 PM, CHARLEY REID

M:\PUYALLUP\19511 WPCP UV System Replacement\01 Design\PlanSet\General\G_AREA_PLN.dwg, 1/3/2022 1:13 PM, CHARLEY REID

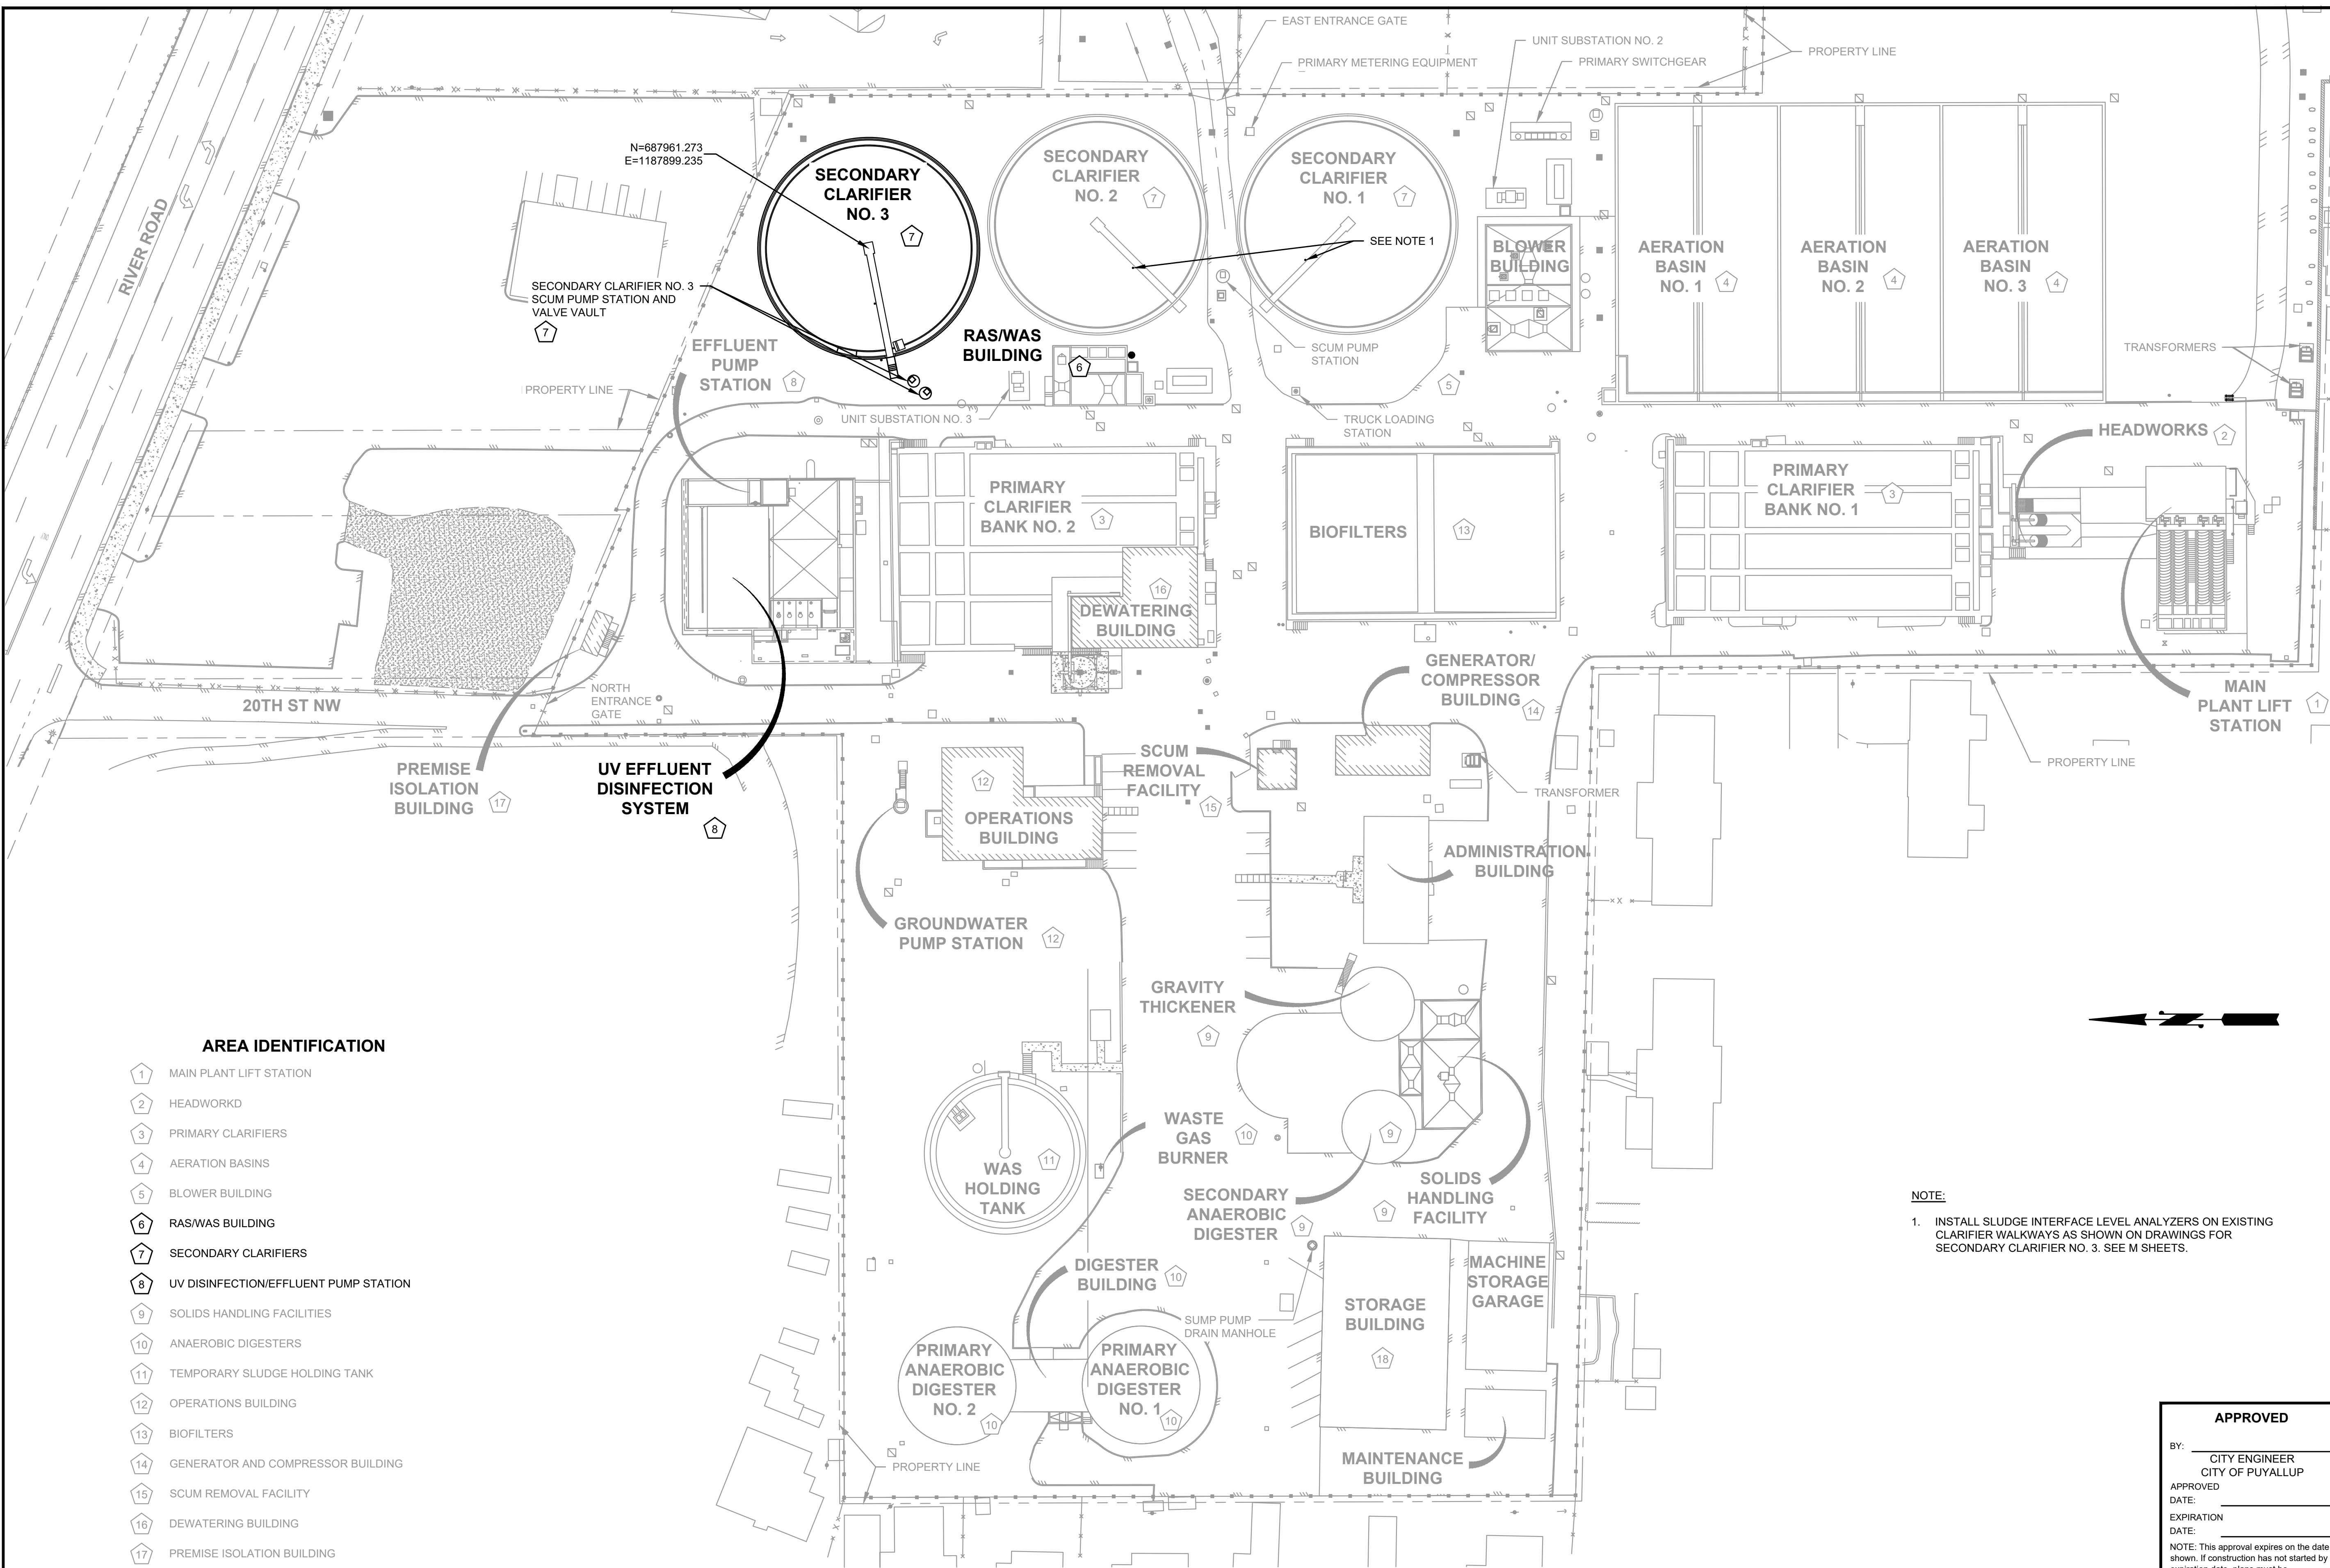

AREA IDENTIFICATION

- 1 MAIN PLANT LIFT STATION
- 2 HEADWORKD
- 3 PRIMARY CLARIFIERS
- 4 AERATION BASINS
- 5 BLOWER BUILDING
- 6 RAS/WAS BUILDING
- 7 SECONDARY CLARIFIERS
- 8 UV DISINFECTION/EFFLUENT PUMP STATION
- 9 SOLIDS HANDLING FACILITIES
- 10 ANAEROBIC DIGESTERS
- 11 TEMPORARY SLUDGE HOLDING TANK
- 12 OPERATIONS BUILDING
- 13 BIOFILTERS
- 14 GENERATOR AND COMPRESSOR BUILDING
- 15 SCUM REMOVAL FACILITY
- 16 DEWATERING BUILDING
- 17 PREMISE ISOLATION BUILDING

NEW SITE PLAN
SCALE: 1"=40'


Gray & Osborne, Inc.
CONSULTING ENGINEERS
1130 RAINIER AVENUE SOUTH,
SUITE 300
SEATTLE, WASHINGTON 98144
(206) 284-0860



CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: DAW		
CHECKED BY: KPS		
DRAWN BY: CRR		
DESIGNER: DAW		
G & O JOB NO.: 21462		
FILE: G_AREA_PLN.DWG		




GENERAL

APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

**NEW SITE PLAN AND
AREA IDENTIFICATION**


DRAWING: **G-7** OF: **8**

NOTE:
1. INSTALL SLUDGE INTERFACE LEVEL ANALYZERS ON EXISTING CLARIFIER WALKWAYS AS SHOWN ON DRAWINGS FOR SECONDARY CLARIFIER NO. 3. SEE M SHEETS.

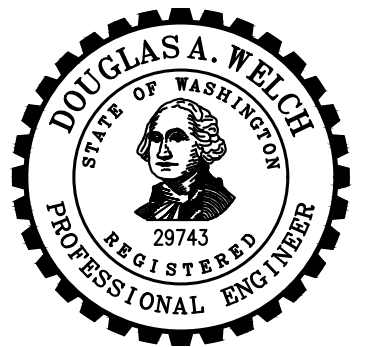

**PRELIMINARY
 NOT FOR
 CONSTRUCTION**


No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: DAW		
CHECKED BY: KPS		
DRAWN BY: CRR		
DESIGNER: DAW		
G & O JOB NO.: 21462		
FILE: G_PIPE_PLN.DWG		



GENERAL



APPROVED
 BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP
 APPROVED
 DATE: _____
 EXPIRATION
 DATE: _____
 NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
 The City will not be responsible for errors and/or omissions on these plans.
 Field conditions may dictate changes to these plans as determined by the City Engineer.

SITE PIPING PLAN

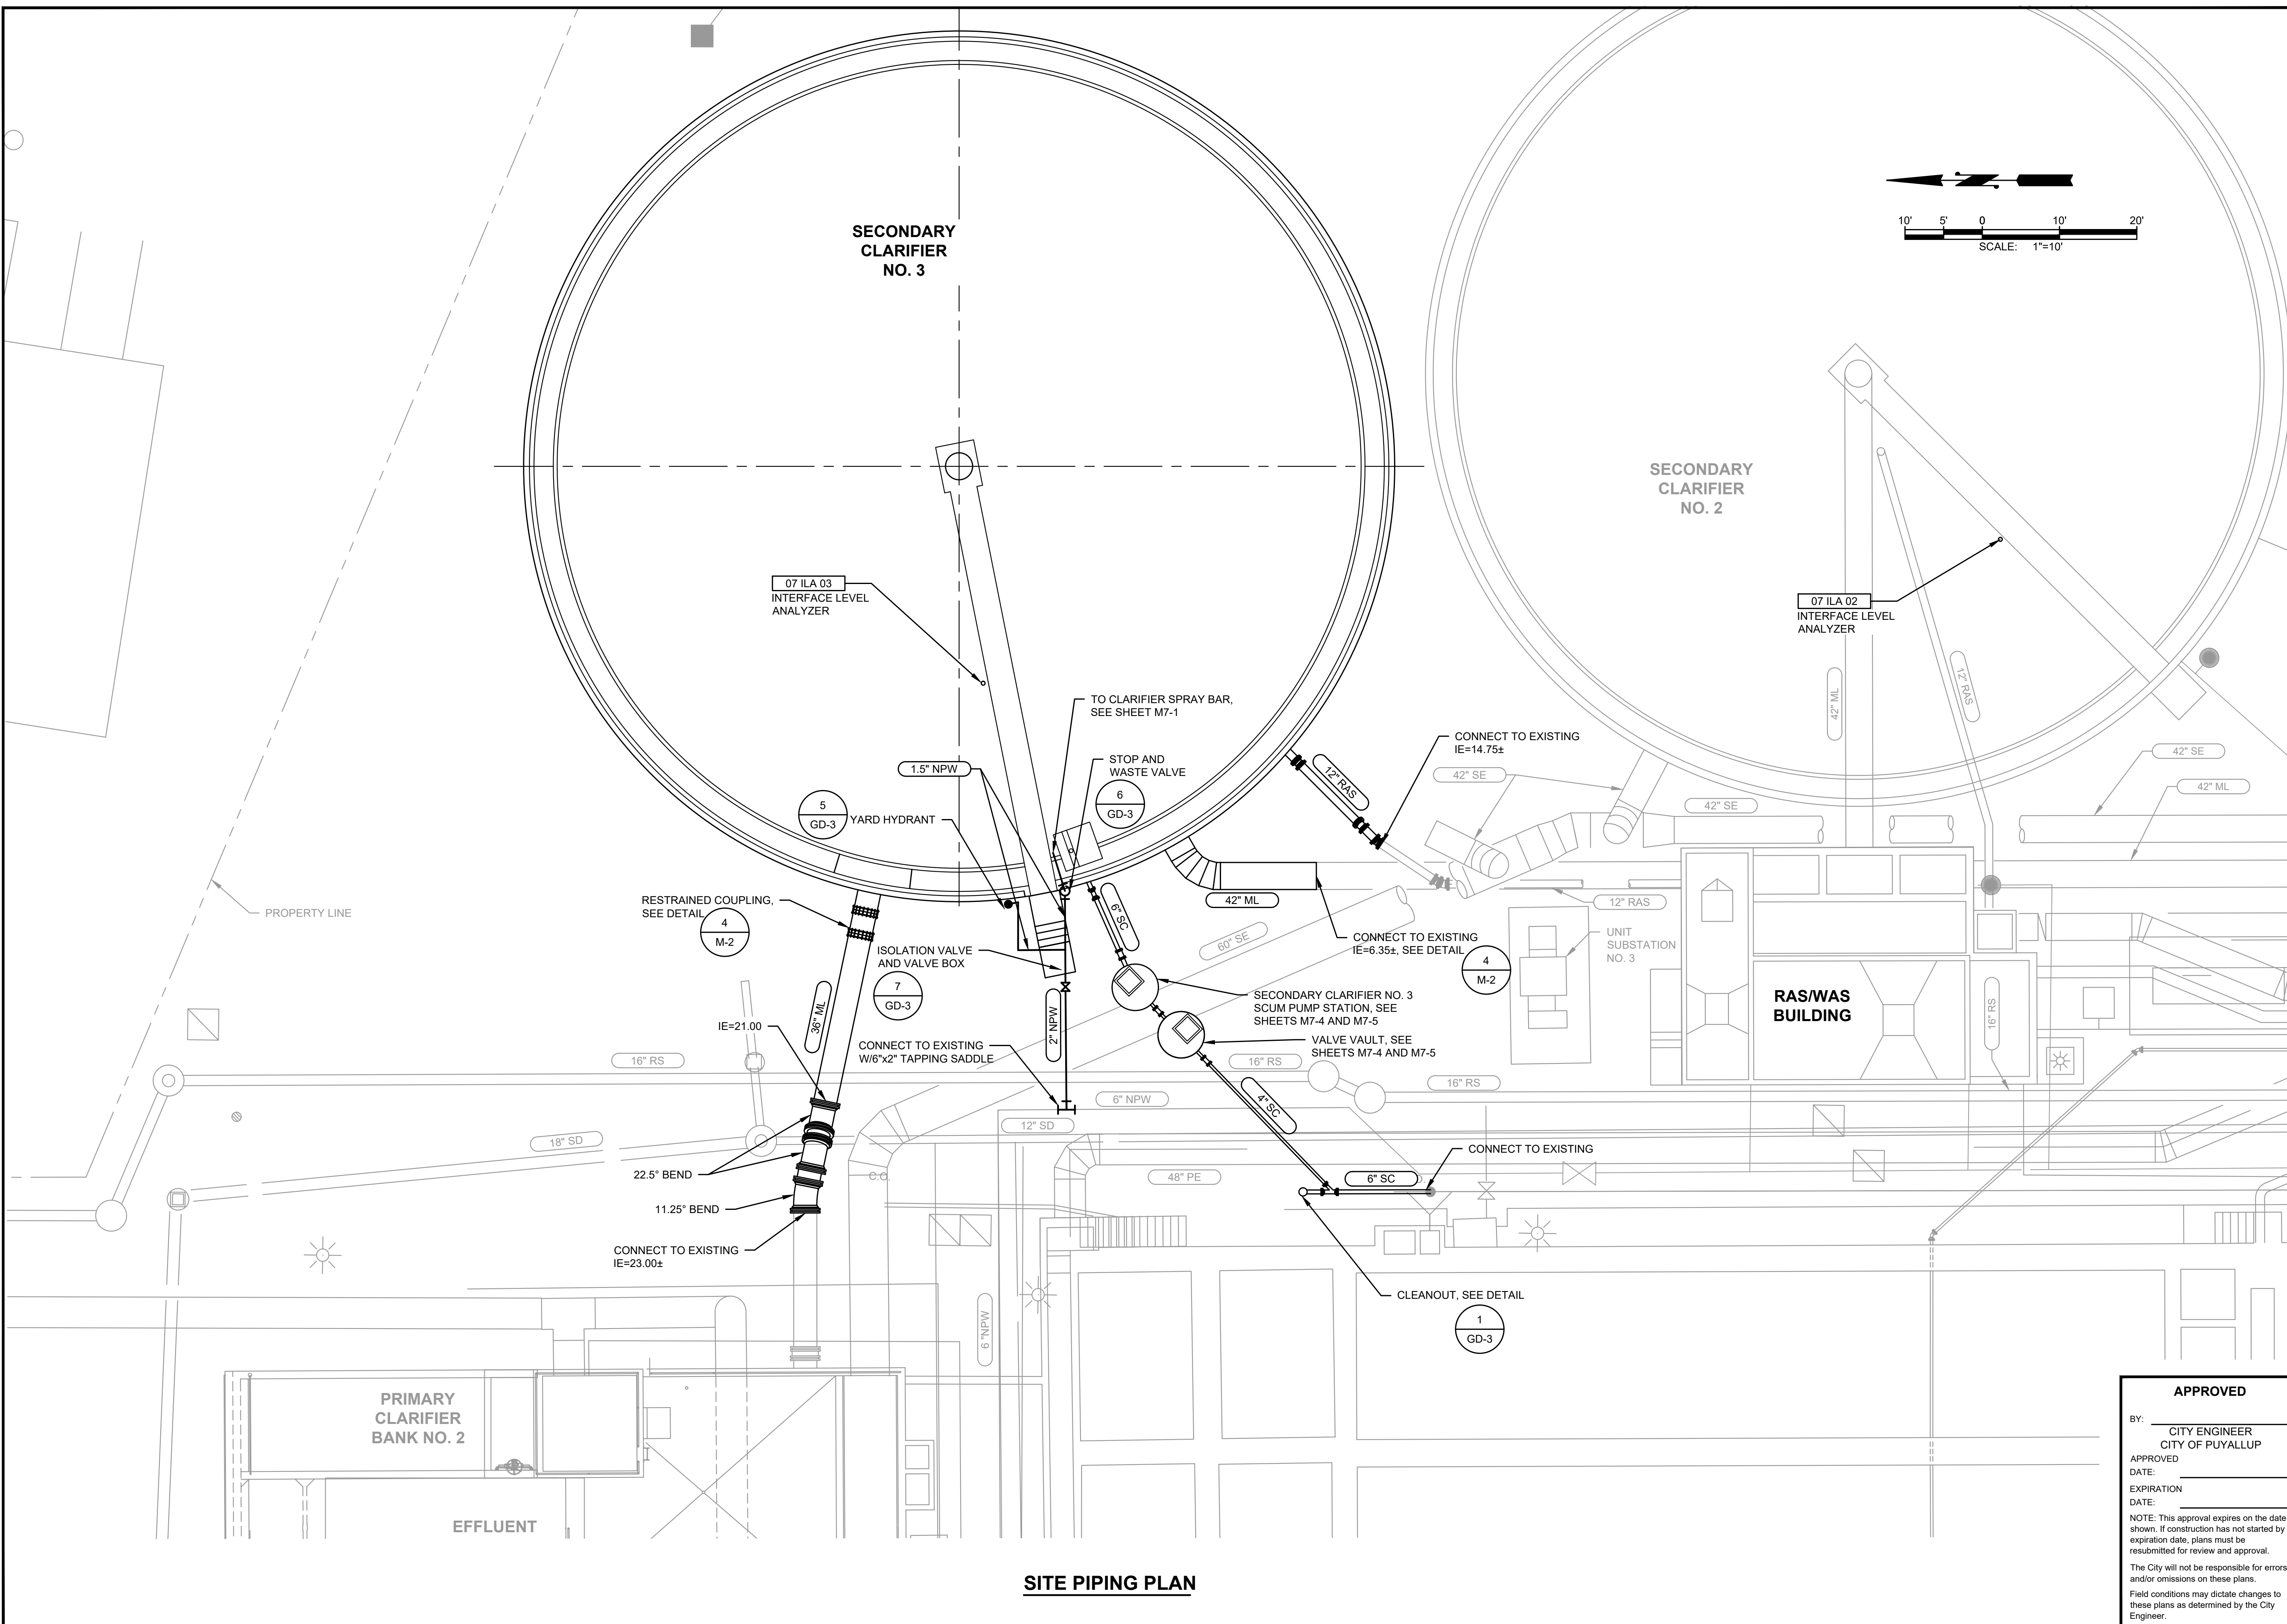

SITE PIPING PLAN

m:\PUYALLUP\19511 WPCCP UV System Replacement\01 Design\Plan\set\General\G_PIPE_PLN.dwg, 1/3/2022 1:14 PM, CHARLEY REID

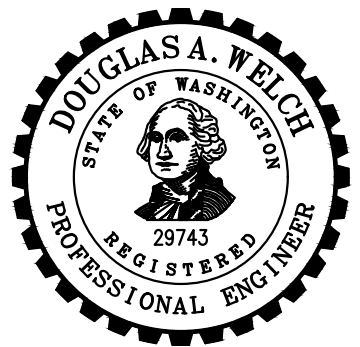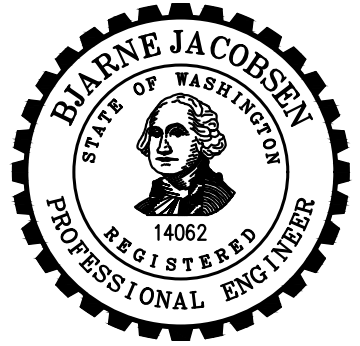


CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION

ISSUED FOR:
90% DESIGN REVIEW
ISSUE DATE: DECEMBER 2021
APPROVED BY: DAW
CHECKED BY: KPS
DRAWN BY: CRR
DESIGNER: DAW
G & O JOB NO.: 21462
FILE: GD_DET.DWG




GENERAL

APPROVED
By: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.


TESC NOTES AND DETAILS

DRAWING: **GD-1** OF: **3**

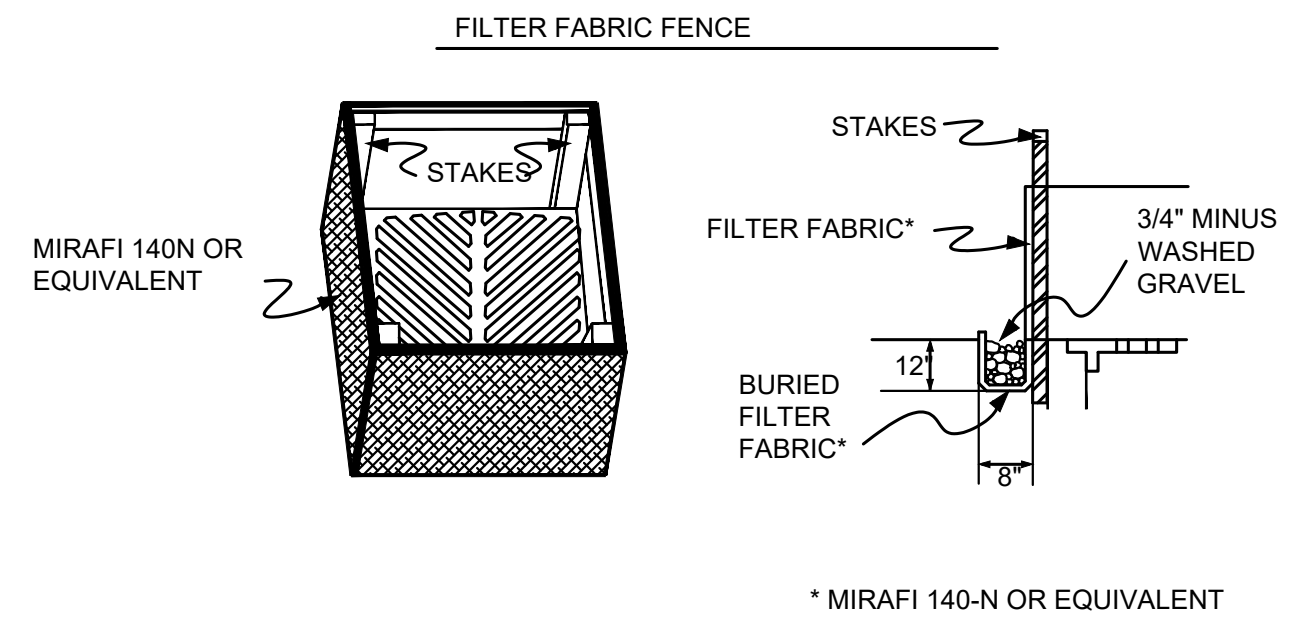

- NOTES:**
1. PLACE 2-INCH BY 2-INCH WOODEN STAKES AROUND THE PERIMETER OF THE INLET A MAXIMUM OF 3 FEET APART AND DRIVE THEM AT LEAST 8-INCHES INTO THE GROUND. THE STAKES MUST BE AT LEAST 3 FEET LONG.
 2. EXCAVATE A TRENCH APPROXIMATELY 8-INCHES WIDE AND 12-INCHES DEEP AROUND THE OUTSIDE PERIMETER OF THE STAKES.
 3. STAPLE THE FILTER FABRIC* TO THE WOODEN STAKES SO THAT 32-INCHES OF THE FABRIC EXTENDS AND CAN BE FORMED INTO THE TRENCH, AND USE HEAVY-DUTY WIRE STAPLES AT LEAST 1/2-INCHES LONG.
 4. BACKFILL THE TRENCH WITH 3/4-INCH MINUS WASHED GRAVEL ALL THE WAY AROUND.

1 STORM DRAIN FILTER FABRIC FENCE BARRIER
TYP NOT TO SCALE

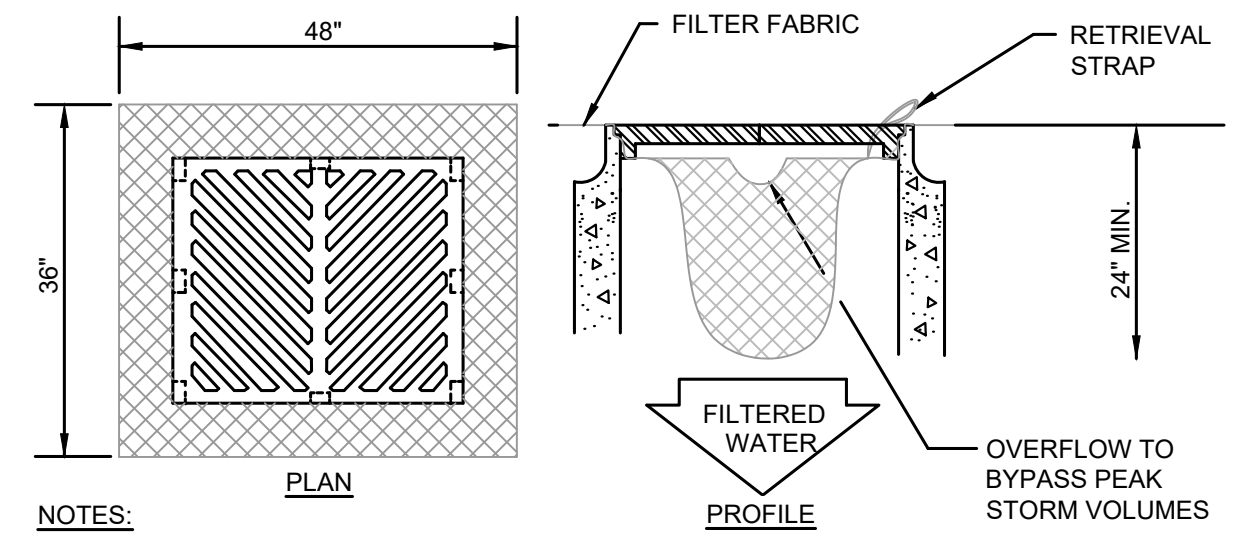

- NOTES:**
1. REMOVE CATCH BASIN GRATING.
 2. CLEAN DIRT AND DEBRIS FROM GRATING LEDGE.
 3. LAY THE CATCH BASIN INSERT INSIDE THE BASIN
 4. REPLACE THE GRATING, PINCHING THE INSERT FABRIC BETWEEN THE GRATING AND THE CATCH BASIN FRAME.
 5. CUT OFF THE EXCESS FABRIC OFF WITH A BLADE KNIFE. A 3 TO 5 INCH WIDE STRIP OF FABRIC SHOULD BE LEFT AROUND THE OUTSIDE OF THE GRATING IF THE INSERT IS TO BE USED MORE THAN ONCE.


2 FILTER FABRIC CATCH BASIN INSERT FOR SEDIMENT ONLY
TYP NOT TO SCALE

- GENERAL NOTES:**
1. ALL LIMITS OF CLEARING AND AREAS OF VEGETATION PRESERVATION AS PRESCRIBED ON THE PLANS SHALL BE CLEARLY FLAGGED IN THE FIELD AND OBSERVED DURING CONSTRUCTION.
 2. ALL REQUIRED SEDIMENTATION AND EROSION CONTROL FACILITIES MUST BE CONSTRUCTED AND IN OPERATION PRIOR TO ANY LAND CLEARING AND/OR OTHER CONSTRUCTION TO ENSURE THAT SEDIMENT LADEN WATER DOES NOT ENTER THE NATURAL DRAINAGE SYSTEM. THE CONTRACTOR SHALL SCHEDULE AN INSPECTION OF THE EROSION CONTROL FACILITIES PRIOR TO ANY LAND CLEARING AND/OR CONSTRUCTION. ALL EROSION AND SEDIMENT FACILITIES SHALL BE MAINTAINED IN A SATISFACTORY CONDITION AS DETERMINED BY THE CITY, UNTIL SUCH TIME THAT CLEARING AND/OR CONSTRUCTION IS COMPLETED AND THE POTENTIAL FOR ON-SITE EROSION HAS PASSED. THE IMPLEMENTATION, MAINTENANCE, REPLACEMENT, AND ADDITIONS TO THE EROSION AND SEDIMENTATION CONTROL SYSTEMS SHALL BE THE RESPONSIBILITY OF THE PERMITEE.
 3. THE EROSION AND SEDIMENTATION CONTROL SYSTEM FACILITIES DEPICTED ON THESE PLANS ARE INTENDED TO BE MINIMUM REQUIREMENTS TO MEET ANTICIPATED SITE CONDITIONS. AS CONSTRUCTION PROGRESSES AND UNEXPECTED OR SEASONAL CONDITIONS DICTATE, FACILITIES WILL BE NECESSARY TO ENSURE COMPLETE SILTATION CONTROL ON THE SITE. DURING THE COURSE OF CONSTRUCTION, IT SHALL BE THE OBLIGATION AND RESPONSIBILITY OF THE PERMITEE TO ADDRESS ANY NEW CONDITIONS THAT MAY BE CREATED BY HIS ACTIVITIES AND TO PROVIDE ADDITIONAL FACILITIES, OVER AND ABOVE THE MINIMUM REQUIREMENTS, AS MAY BE NEEDED TO PROTECT ADJACENT PROPERTIES, SENSITIVE AREAS, NATURAL WATER COURSES, AND/OR STORM DRAINAGE SYSTEMS.
 4. APPROVAL OF THESE PLANS IS FOR GRADING, TEMPORARY DRAINAGE, EROSION AND SEDIMENTATION CONTROL ONLY. IT DOES NOT CONSTITUTE AN APPROVAL OF PERMANENT STORM DRAINAGE DESIGN, SIZE OR LOCATION OF PIPES, RESTRICTORS, CHANNELS, OR RETENTION FACILITIES.
 5. ANY DISTURBED AREA WHICH HAS BEEN STRIPPED OF VEGETATION AND WHERE NO FURTHER WORK IS ANTICIPATED FOR A PERIOD OF 30 DAYS OR MORE, MUST BE IMMEDIATELY STABILIZED WITH MULCHING, GRASS PLANTING, OR OTHER APPROVED EROSION CONTROL TREATMENT APPLICABLE TO THE TIME OF YEAR IN QUESTION. GRASS SEEDING ALONE WILL BE ACCEPTABLE ONLY DURING THE MONTHS OF APRIL THROUGH SEPTEMBER INCLUSIVE. SEEDING MAY PROCEED OUTSIDE THE SPECIFIED TIME PERIOD WHENEVER IT IS IN THE INTEREST OF THE PERMITEE BUT MUST BE AUGMENTED WITH MULCHING, NETTING, OR OTHER TREATMENT APPROVED BY THE CITY.
 6. IN CASE EROSION OR SEDIMENTATION OCCURS TO ADJACENT PROPERTIES, ALL CONSTRUCTION WORK WITHIN THE DEVELOPMENT THAT WILL FURTHER AGGRAVATE THE SITUATION MUST CEASE, AND THE OWNER/CONTRACTOR WILL IMMEDIATELY COMMENCE RESTORATION METHODS. RESTORATION ACTIVITY WILL CONTINUE UNTIL SUCH TIME AS THE AFFECTED PROPERTY OWNER IS SATISFIED.
 7. NO TEMPORARY OR PERMANENT STOCKPILING OF MATERIALS OR EQUIPMENT SHALL OCCUR WITHIN CRITICAL AREAS OR ASSOCIATED BUFFERS, OR THE CRITICAL ROOT ZONE FOR VEGETATION PROPOSED FOR RETENTION.
 8. WHERE POSSIBLE, MAINTAIN NATURAL VEGETATION FOR SILT CONTROL.
 9. TEMPORARY SILTATION CONTROL AND DETENTION PONDS TO BE CONSTRUCTED BY PLACING GRAVEL FILLED BURLAP SACKS.
 10. FILTER FABRIC FENCES OR GRAVEL SACKS TO BE LOCATED AS INDICATED ON THE PLANS OR AS REQUIRED.
 11. TO PROVIDE EROSION CONTROL ON STEEP AND NEWLY GRADED SLOPES, CONTRACTOR SHALL EMPLOY EROSION CONTROL BLANKET OR CLEAR PLASTIC IMMEDIATELY AFTER GRADING SLOPES AND THE APPLICATION OF SEEDING.
 12. ALL TEMPORARY EROSION CONTROL STRUCTURES SHALL BE MAINTAINED IN SATISFACTORY CONDITION UNTIL CLEARING AND/OR CONSTRUCTION IS COMPLETED AND SURFACE RESTORATION HAS BEEN COMPLETED.
 13. RETURN SILTATION CONTROL AREAS TO ORIGINAL GROUND CONDITIONS UNLESS OTHERWISE NOTED.

1. DISTURBED AREAS WHICH ARE TO REMAIN WITHOUT PERMANENT COVER FOR MORE THAN 30 DAYS, SHALL BE STABILIZED BY PROVIDING TEMPORARY SEEDING, MULCHING, MATTING, OR CLEAR PLASTIC COVERING AS A GUARD AGAINST EROSION.
- STABILIZATION AND REMOVAL:**
1. ALL TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES SHALL BE REMOVED WITHIN 30 DAYS AFTER FINAL SITE STABILIZATION IS ACHIEVED OR AFTER THE TEMPORARY "BEST MANAGEMENT PRACTICES" ARE NO LONGER NEEDED. TRAPPED SEDIMENT SHALL BE REMOVED OR STABILIZED ON SITE. DISTURBED SOIL AREAS RESULTING FROM REMOVAL SHALL BE PERMANENTLY STABILIZED.
- CLEAR PLASTIC COVERINGS:**
1. CLEAR PLASTIC COVERINGS SHALL HAVE A MINIMUM THICKNESS OF 6 MIL AND MEET THE REQUIREMENTS OF WSDOT/APWA SECTION 9-14.5.
 2. COVERING SHALL BE INSTALLED ON EXPOSED SLOPES SUBJECT TO EROSION AND MAINTAINED TIGHTLY IN PLACE BY USING SANDBAGS OR TIRES OR ROPES WITH A MAXIMUM 10 FOOT GRID SPACING IN ALL DIRECTIONS. ALL SEAMS SHALL BE TAPED OR WEIGHTED DOWN FULL LENGTH AND THERE SHALL BE AT LEAST A 1 TO 2 FOOT OVERLAP OF ALL SEAMS. SEAMS SHOULD THEN BE ROLLED AND STAKED OR TIED.
 3. COVERING SHALL BE INSTALLED IMMEDIATELY ON AREAS SEEDED BETWEEN OCTOBER 1 TO APRIL 30 AND REMAIN UNTIL VEGETATION IS FIRMLY ESTABLISHED.
 4. WHEN THE COVERING IS USED ON UNSEEDED SLOPES, IT SHALL BE LEFT IN PLACE UNTIL THE NEXT SEEDING PERIOD.
 5. SHEETING SHOULD BE TOED IN AT THE TOP OF THE SLOPE TO PREVENT SURFACE FLOW BENEATH THE PLASTIC.
 6. SHEETING SHOULD BE REMOVED AS SOON AS IS POSSIBLE ONCE VEGETATION IS WELL ESTABLISHED TO PREVENT BURNING THE VEGETATION.
 7. CHECK SHEETING REGULARLY FOR RIPS AND PLACES WHERE THE PLASTIC MAY BE DISLODGED. CONTACT BETWEEN THE PLASTIC AND THE GROUND SHOULD ALWAYS BE MAINTAINED. ANY AIR BUBBLES FOUND SHOULD BE REMOVED IMMEDIATELY OR THE PLASTIC MAY RIP DURING THE NEXT WINDY PERIOD. RE-ANCHOR OR REPLACE THE PLASTIC AS NECESSARY.


TEMPORARY COVER PRACTICES:

m:\PUYALLUP\21462\wpcp_3rd_secondary_clarifier01_design\plans\set\General\GD_DET.dwg, 1/3/2022, 1:14 PM, CHARLEY REID

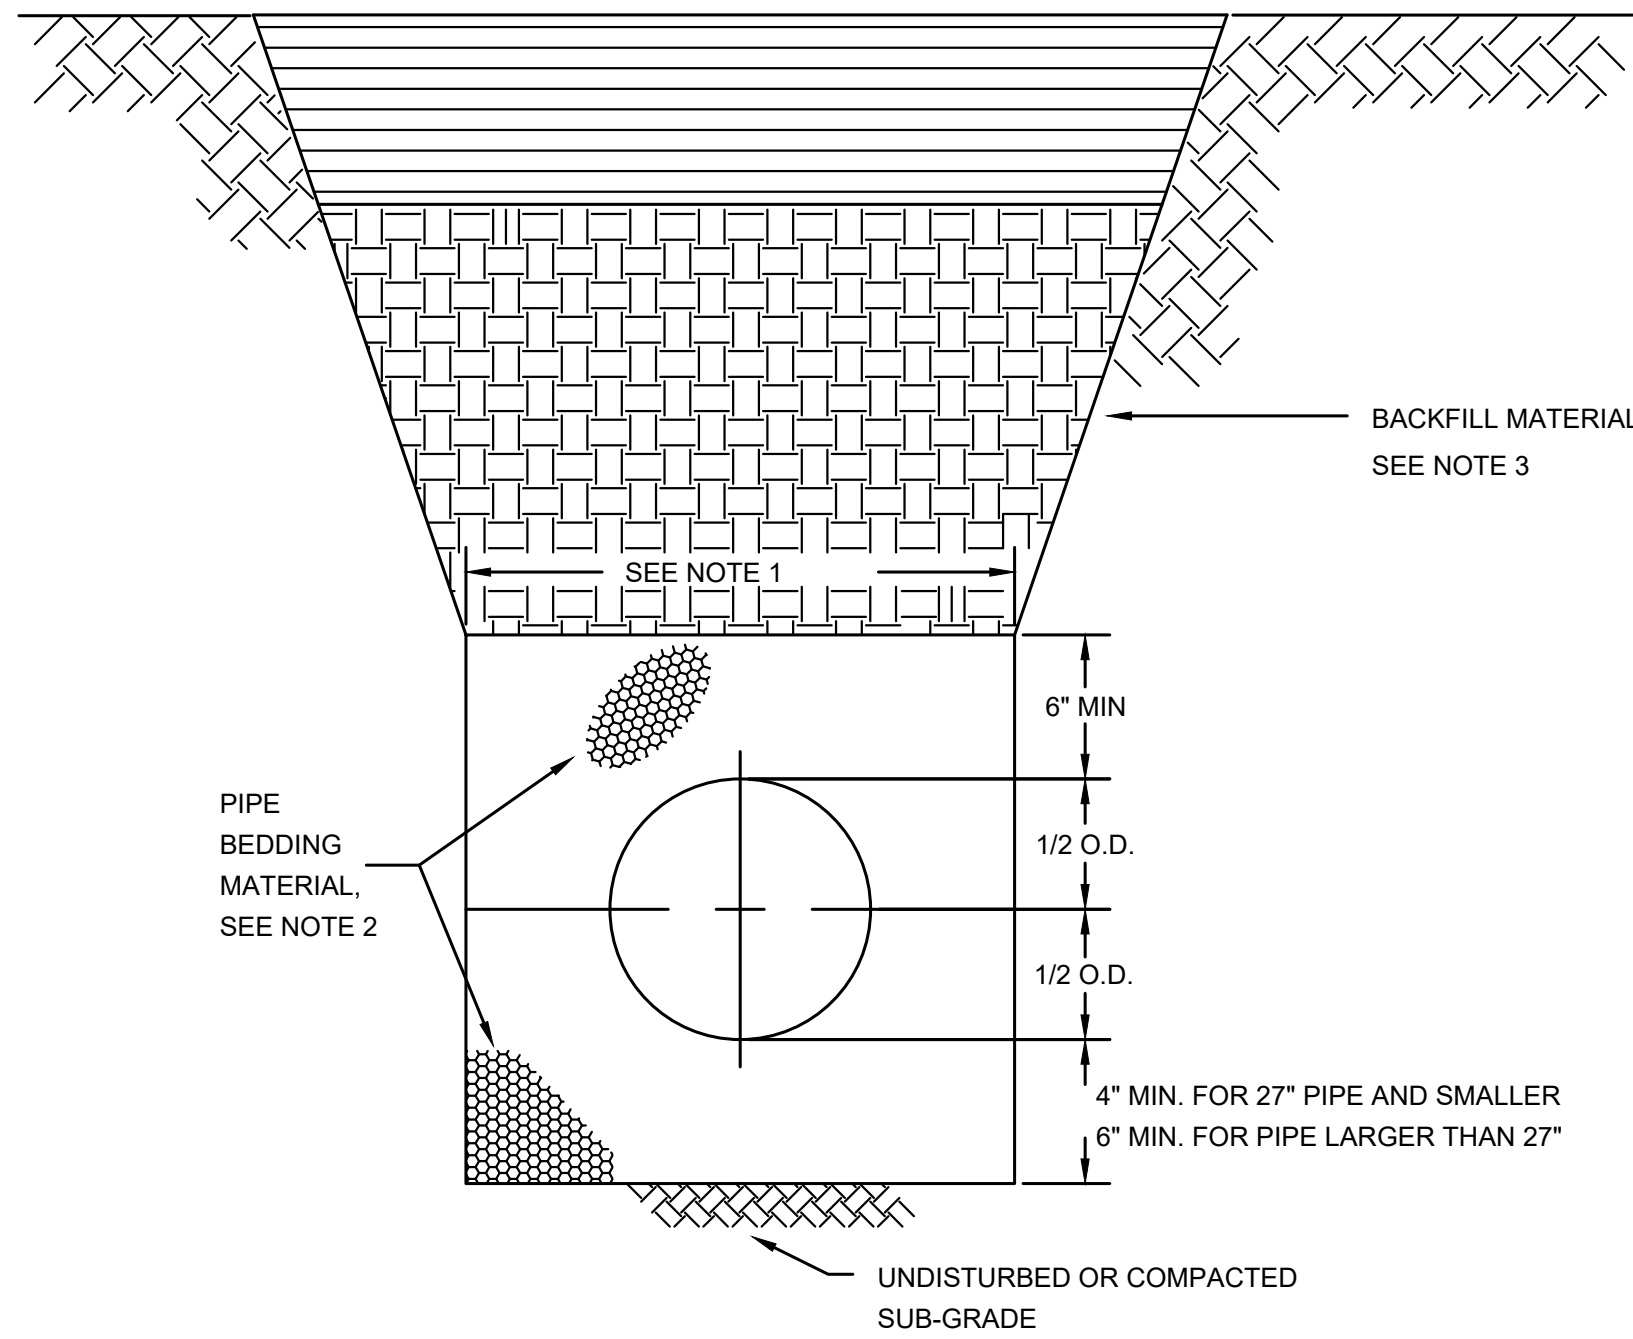


- NOTES:**
1. TRENCHING SHALL MEET THE REQUIREMENTS OF SECTION 7-08.3(1)A AND 2-06.3(1) OF THE WSDOT SPECIFICATIONS.
 2. BEDDING MATERIAL FOR PIPE SHALL BE CRUSHED OR PARTIALLY CRUSHED MATERIAL CONFORMING TO SPECIFICATION SECTION 02700.2.2. GRAVEL BACKFILL FOR PIPE BEDDING. NATIVE MATERIAL SHALL NOT BE USED FOR PIPE BEDDING.
 3. GRAVEL BACKFILL SHALL CONFORM TO 9-03.12(1)A GRAVEL BACKFILL FOR FOUNDATIONS, CLASS A.

1 TYPICAL TRENCH SECTION
TYP NOT TO SCALE

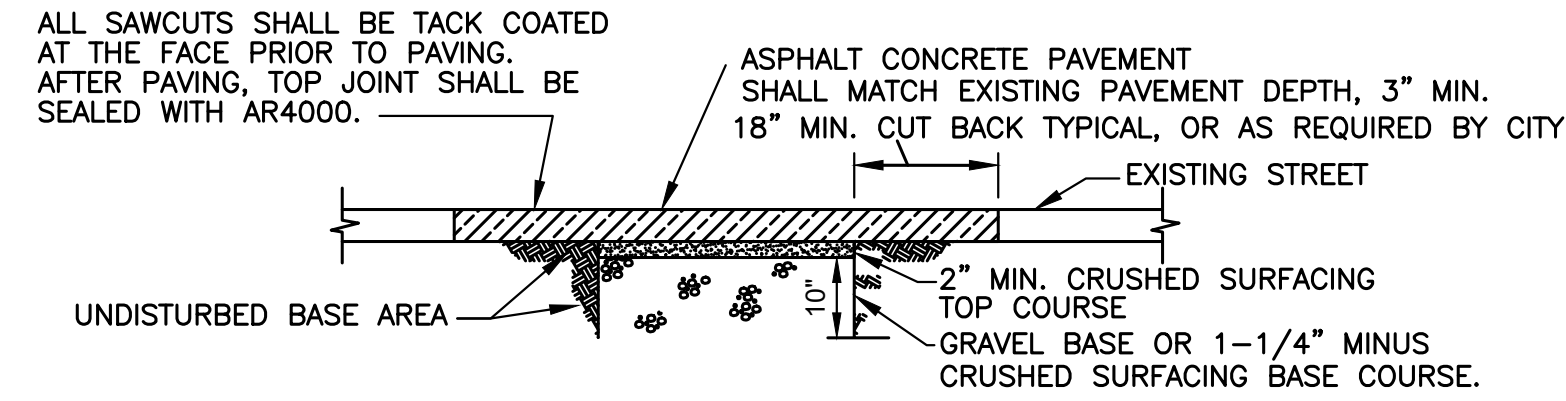


- NOTES:**
1. BASE AND SUBBASE MATERIAL SHALL BE COMPACTED TO 95% OF THE MODIFIED PROCTOR MAXIMUM DRY DENSITY.
 2. ALL DEPTHS INDICATED ARE A MINIMUM COMPACTED DEPTH.
 3. ALL PATCHES 8'x 8' AND SMALLER MAY BE PAVED WITH A PAVING BOX.
 4. INITIAL BACKFILLING SHALL BE PERFORMED ONLY AFTER INSPECTION AND APPROVAL OF THE INSTALLED PIPE OR STRUCTURE. THE BACKFILL MATERIAL SHALL BE PLACED IN ACCORDANCE WITH CITY STANDARD DETAIL NO. 06.01.01
 5. ALL BACKFILL FOR PIPE TRENCHES SHALL BE MECHANICALLY COMPACTED BY A POWER-OPERATED MECHANICAL TAMPER(S) AS SPECIFIED IN WSDOT STANDARD SPEC. 2-03.3 (14)C, COMPACTING EARTH EMBANKMENTS, METHOD C OF THE WSDOT STANDARD SPECIFICATIONS.
 6. INITIAL BACKFILL MATERIAL SHALL BE SELECT TRENCH EXCAVATION MATERIAL.
 7. COMPACTION SHALL BE MADE IN 6-INCH LIFTS.
 8. GRAVEL BASE SHALL MEET THE REQUIREMENTS OF WSDOT STANDARD SPEC. 9-03.10. CRUSHED SURFACING BASE COURSE SHALL MEET THE REQUIREMENTS OF WSDOT STANDARD SPEC. 9-03.9(3).
 9. REFER TO PUYALLUP MUNICIPAL CODE 11.04.040 #4

2 STREET PATCH DETAIL
TYP NOT TO SCALE

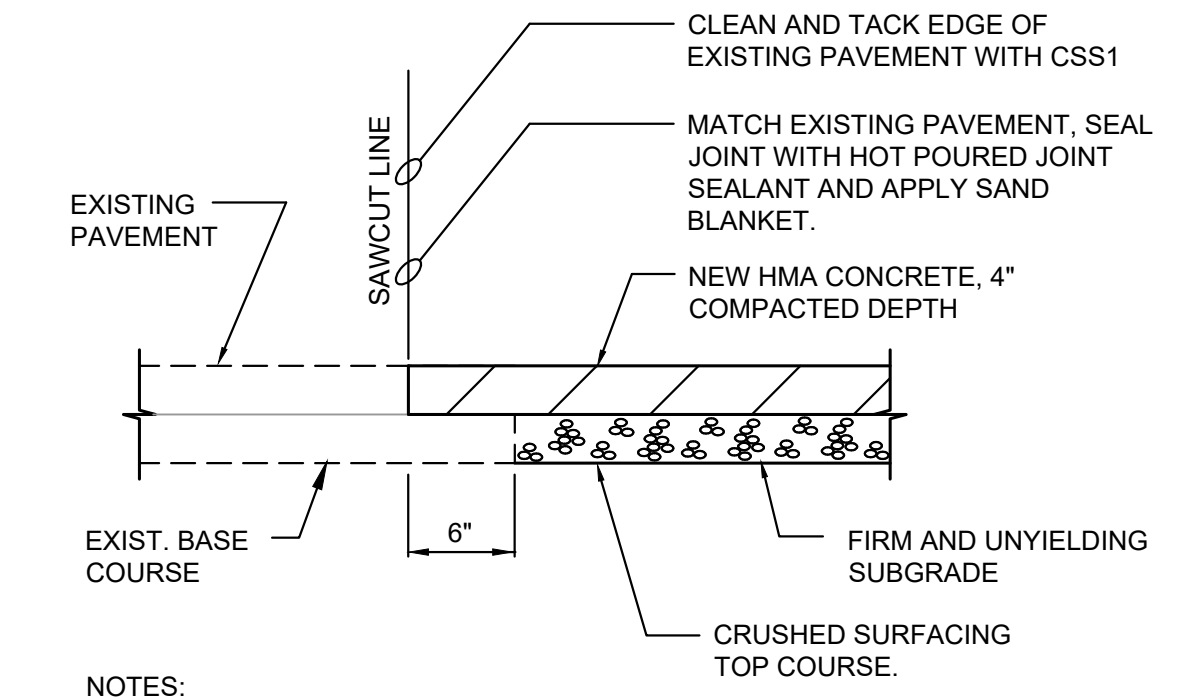


- NOTES:**
1. ALL JOINTS SHALL BE FULL DEPTH SAW CUT.
 2. ALL CATCH BASINS, VALVES AND OTHER APPURTENANCES SHALL BE TACK COATED WITH AN ASPHALT EMULSION PRIOR TO THE APPLICATION OF ASPHALT CONCRETE.
 3. COMPACTED ASPHALT CONCRETE SHALL NOT EXTEND MORE THAN 1/4" ABOVE THE EXISTING SURFACE.

3 ASPHALT BUTT JOINT DETAIL
TYP NOT TO SCALE

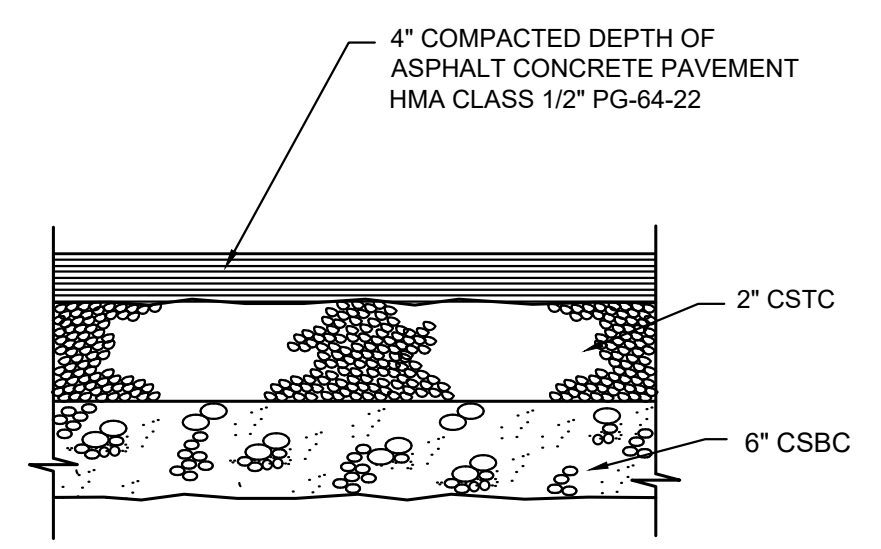


1 ASPHALT PAVEMENT DETAIL
TYP NOT TO SCALE

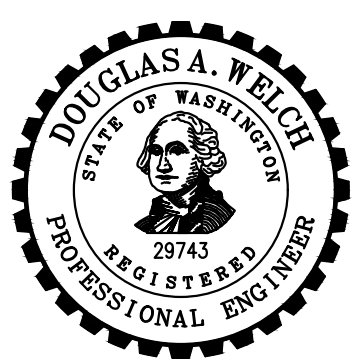

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: DAW		
CHECKED BY: KPS		
DRAWN BY: CRR		
DESIGNER: DAW		
G & O JOB NO.: 21462		
FILE: GD_DET.DWG		



GENERAL

APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP


APPROVED
DATE: _____
EXPIRATION
DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans.

Field conditions may dictate changes to these plans as determined by the City Engineer.

GENERAL DETAILS

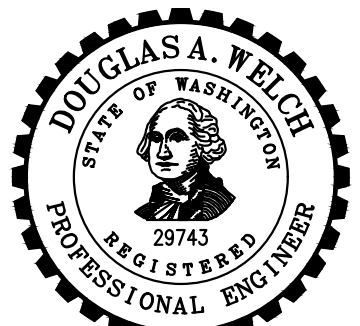

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION

ISSUED FOR:
90% DESIGN REVIEW

ISSUE DATE: DECEMBER 2021

APPROVED BY: DAW


CHECKED BY: KPS

DRAWN BY: CRR

DESIGNER: DAW

G & O JOB NO.: 21462

FILE: GD_DET.DWG



GENERAL

APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP

APPROVED
DATE: _____
EXPIRATION
DATE: _____


NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans.


Field conditions may dictate changes to these plans as determined by the City Engineer.

WASHWATER DETAILS


DRAWING: **GD-3** OF: **3**

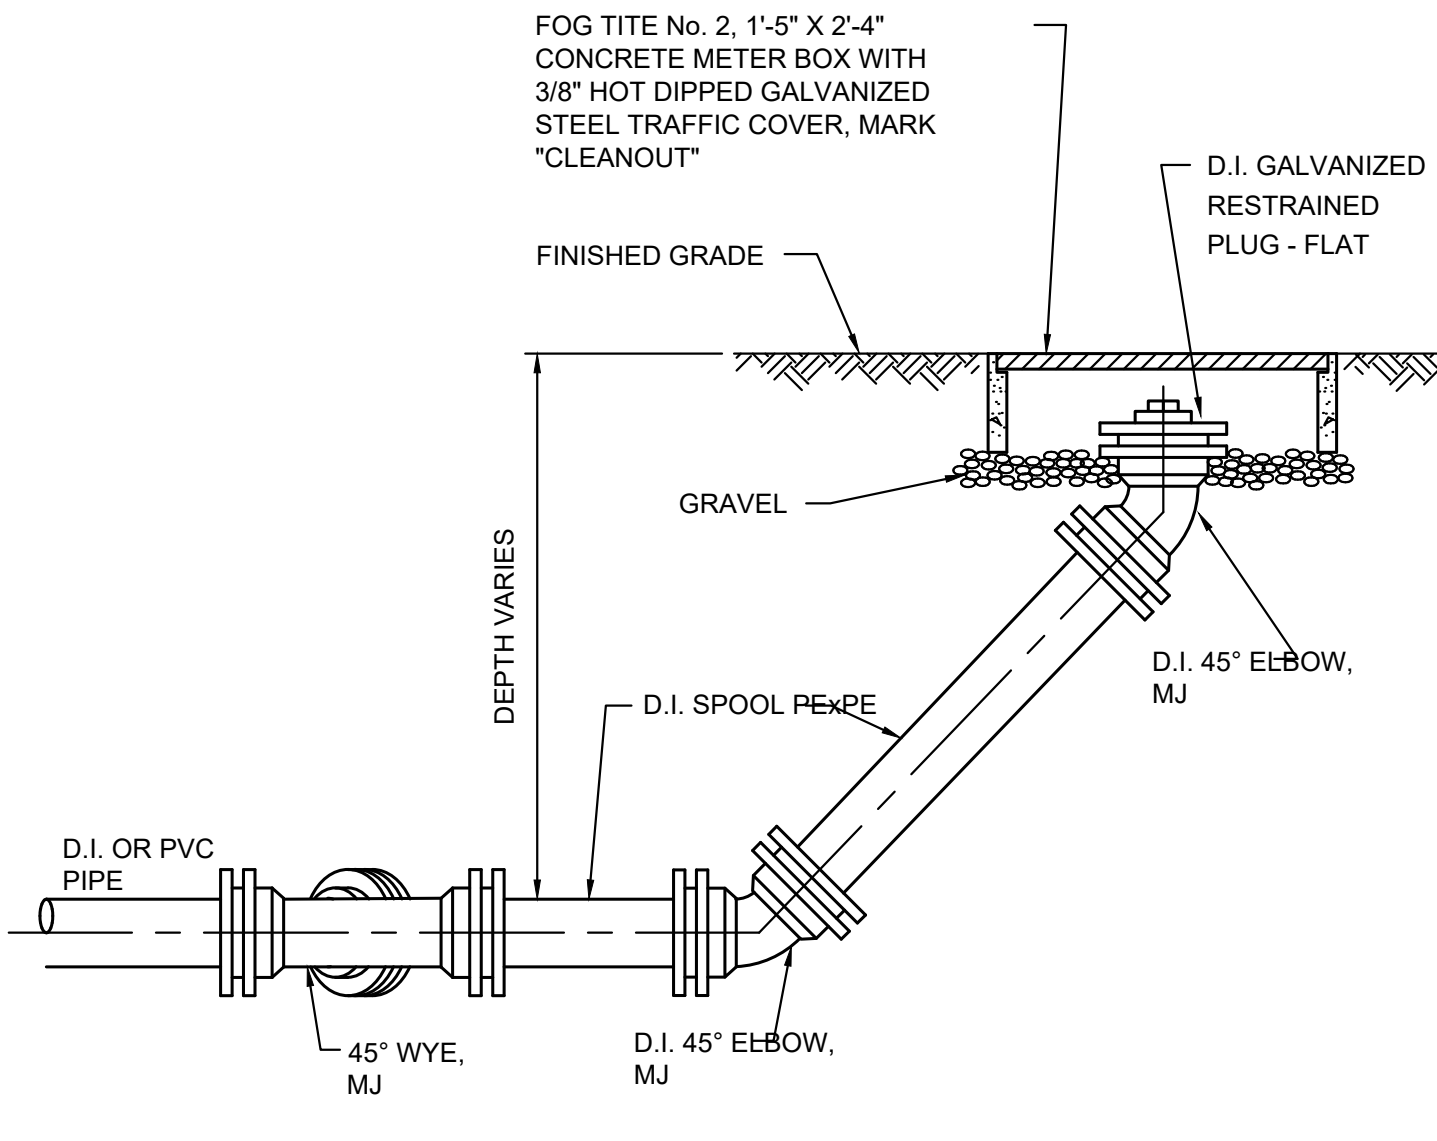

1 TYPICAL CLEANOUT DETAIL
TYP NOT TO SCALE

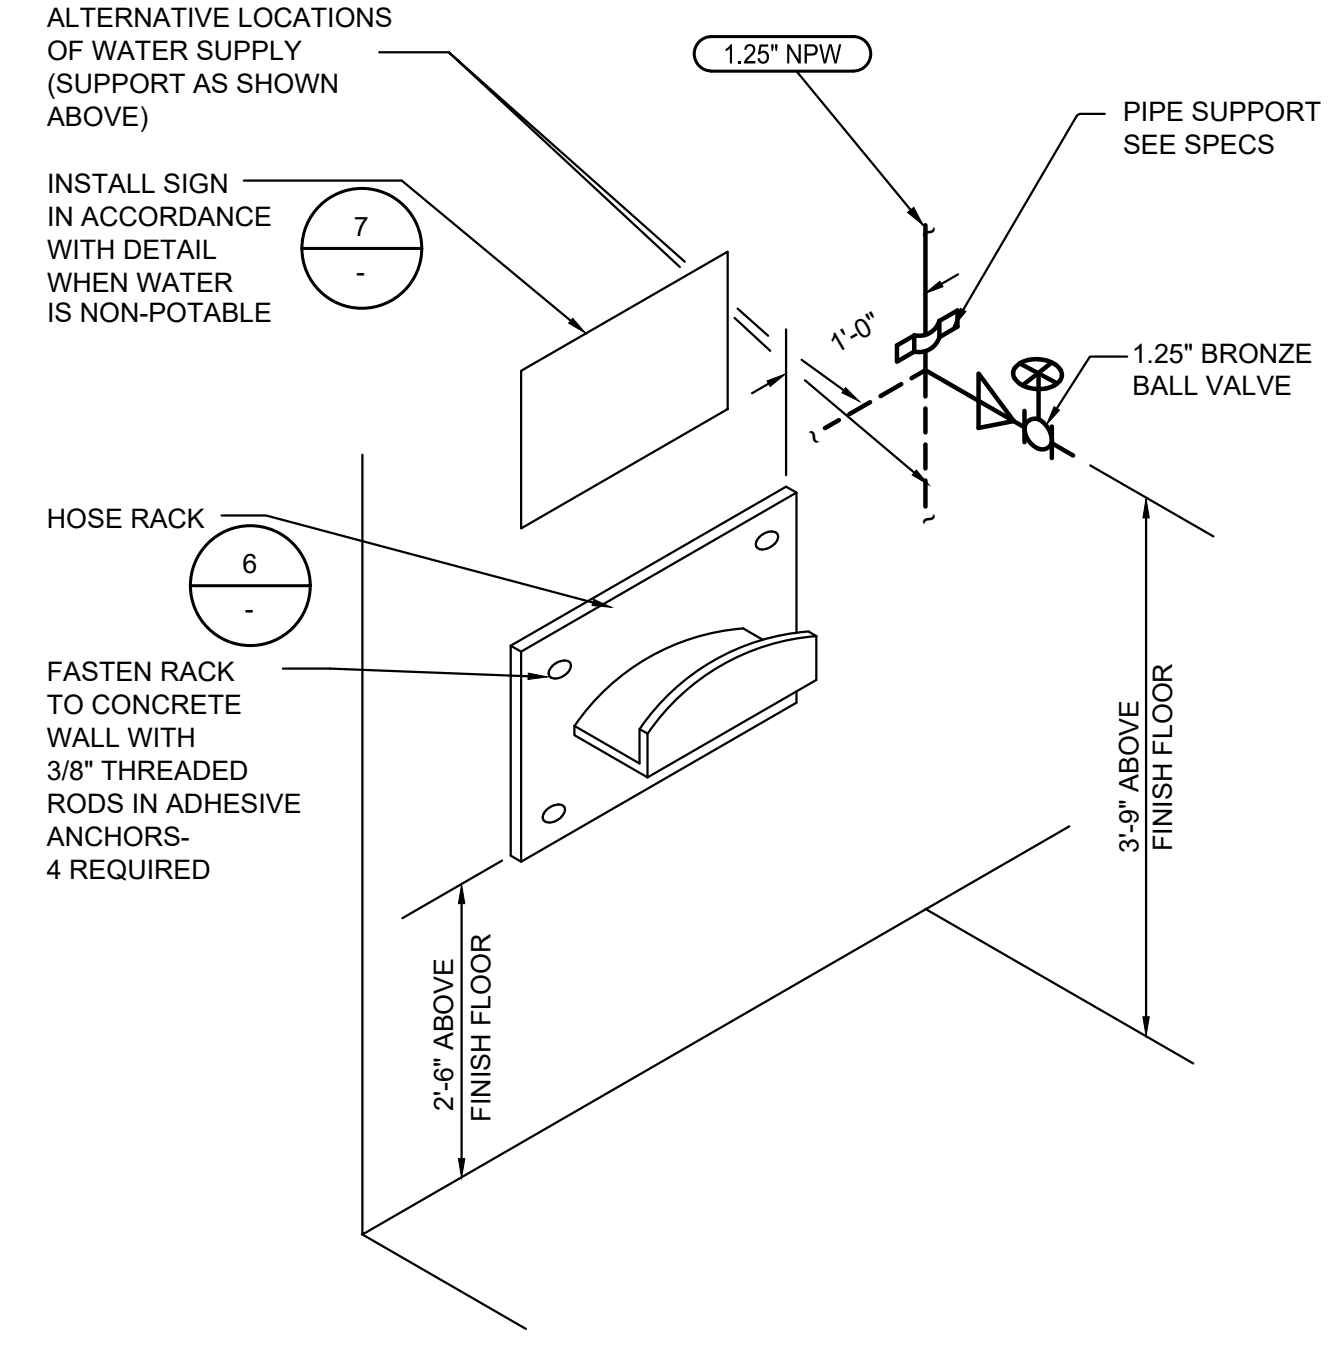


2 TYPICAL UTILITY STATION DETAIL
TYP NOT TO SCALE


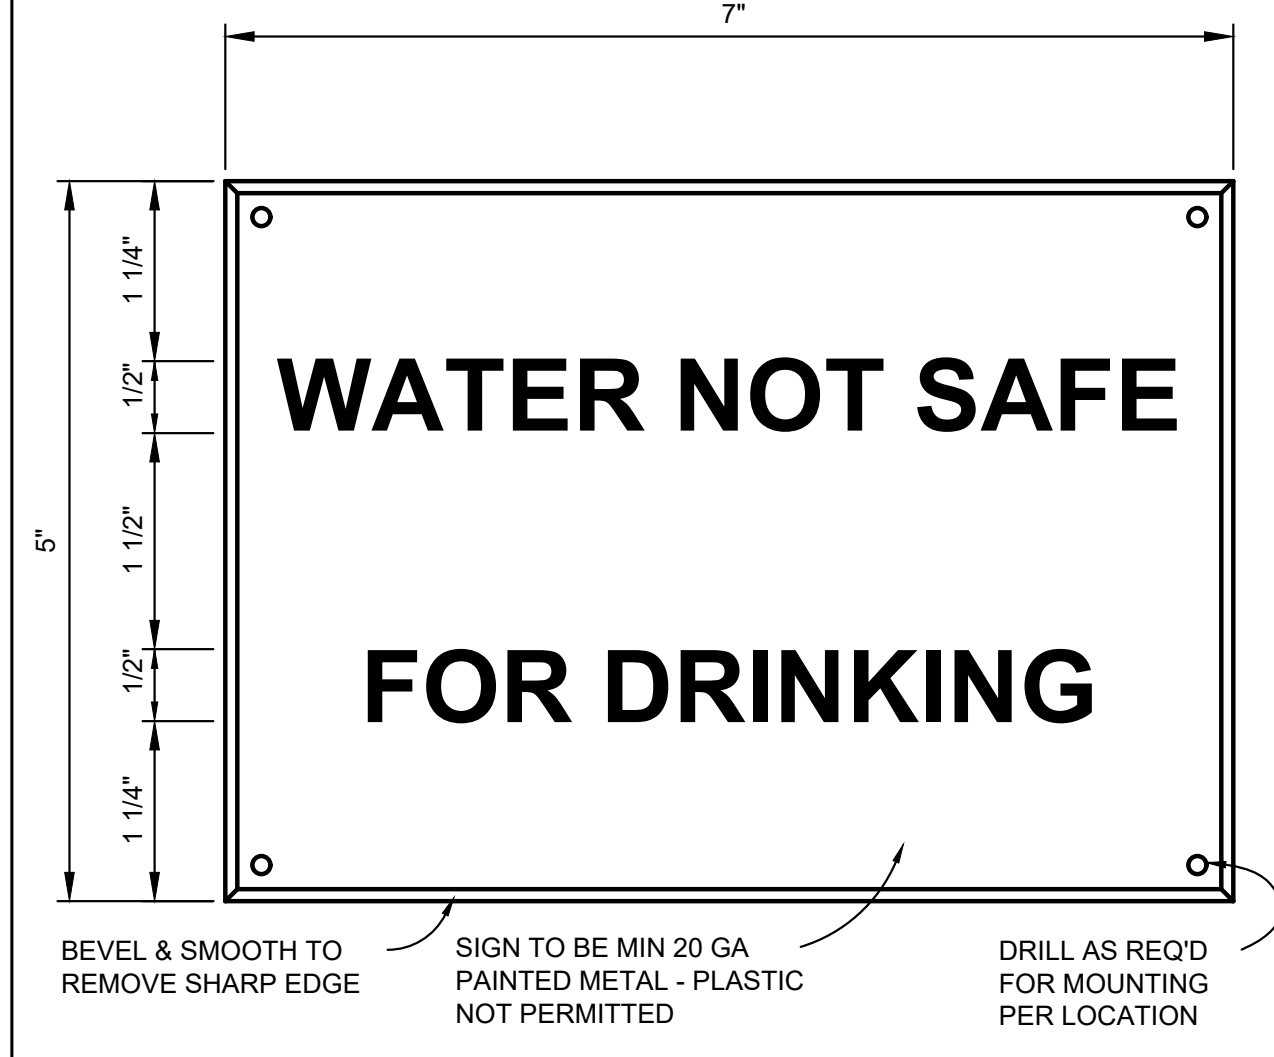


3 NON-POTABLE WATER SIGN DETAIL
TYP NOT TO SCALE

NOTE:
INSTALL NEXT TO ALL YARD HYDRANTS.

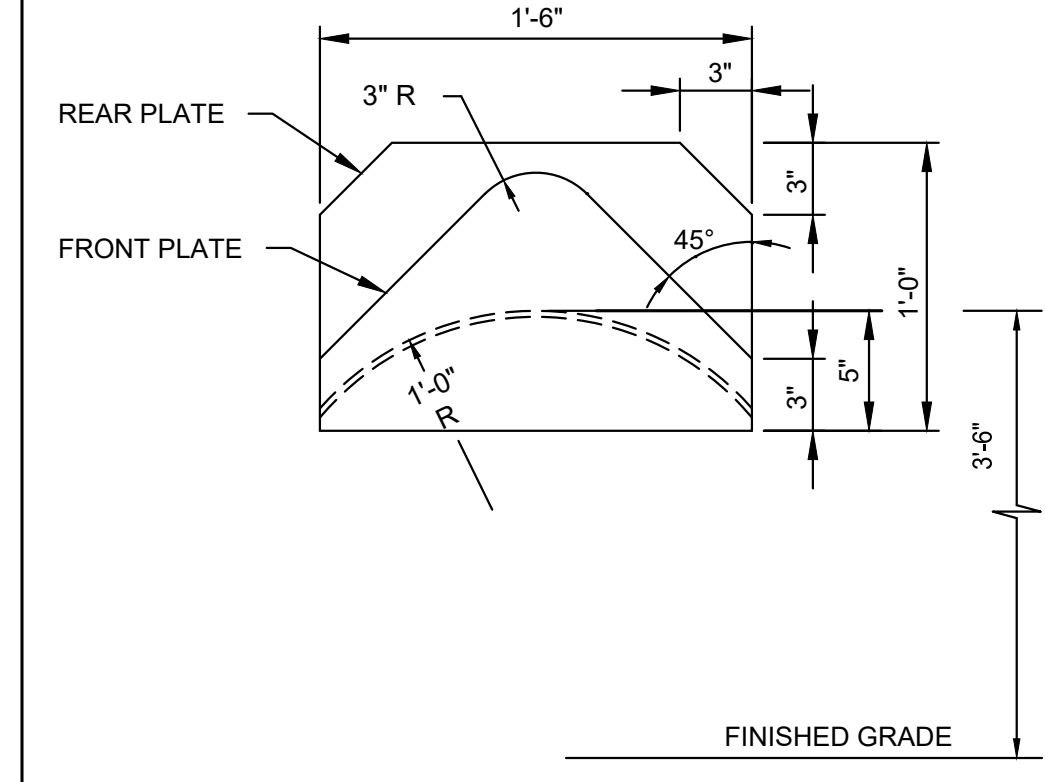


4 HOSE RACK DETAIL
TYP NOT TO SCALE

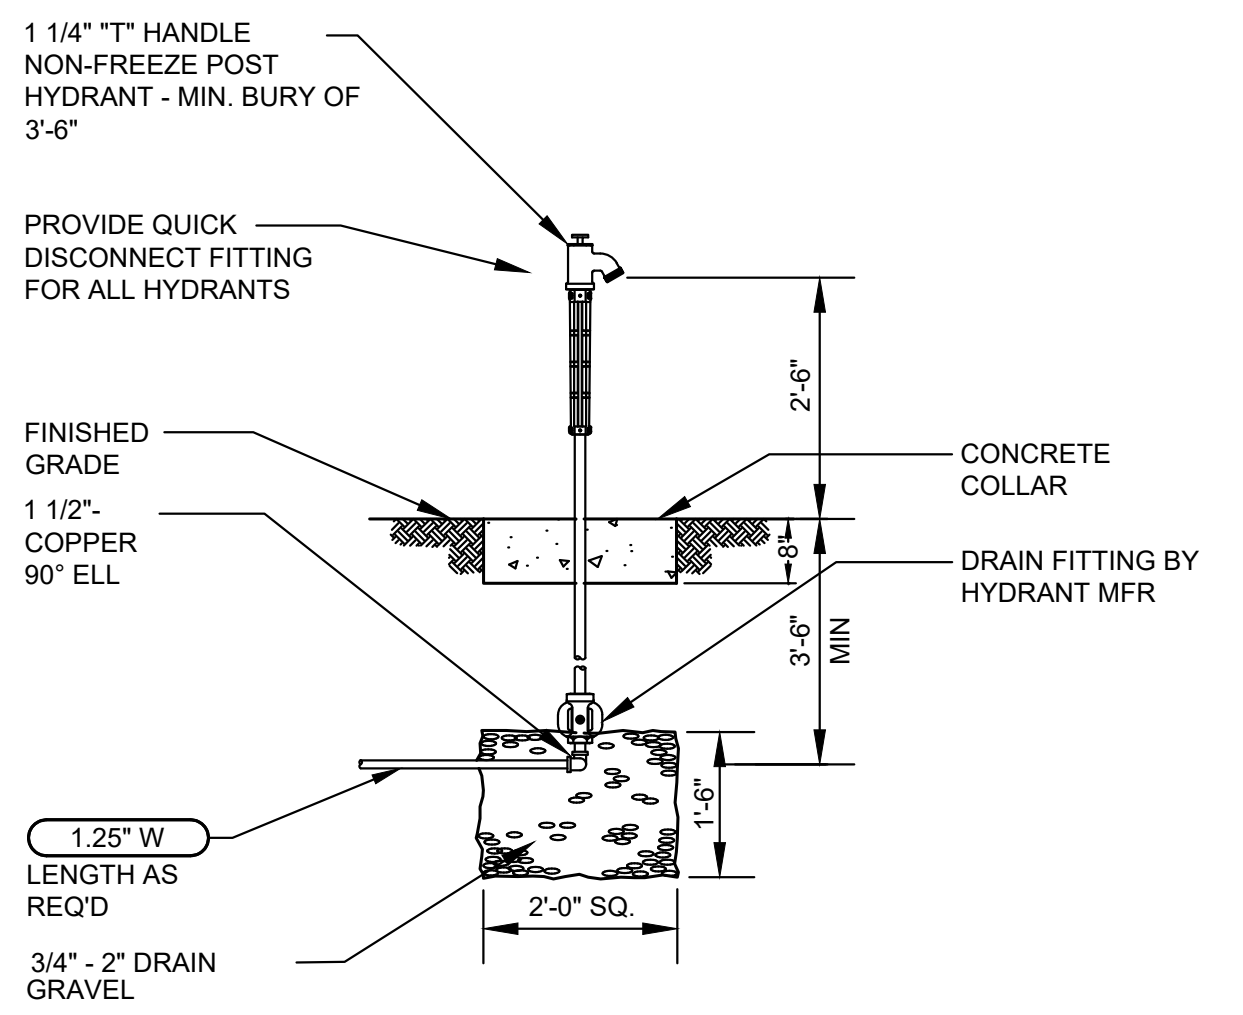
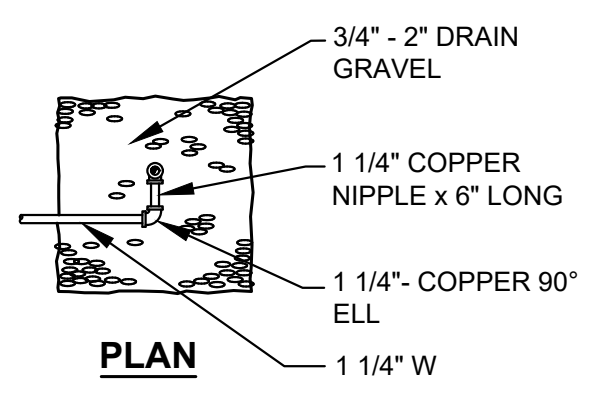


5 1 1/2" NON-FREEZE POST HYDRANT
TYP NOT TO SCALE

NOTE: PROVIDE HOSE RACK WITH EACH YARD HYDRANT. SEE DETAIL.

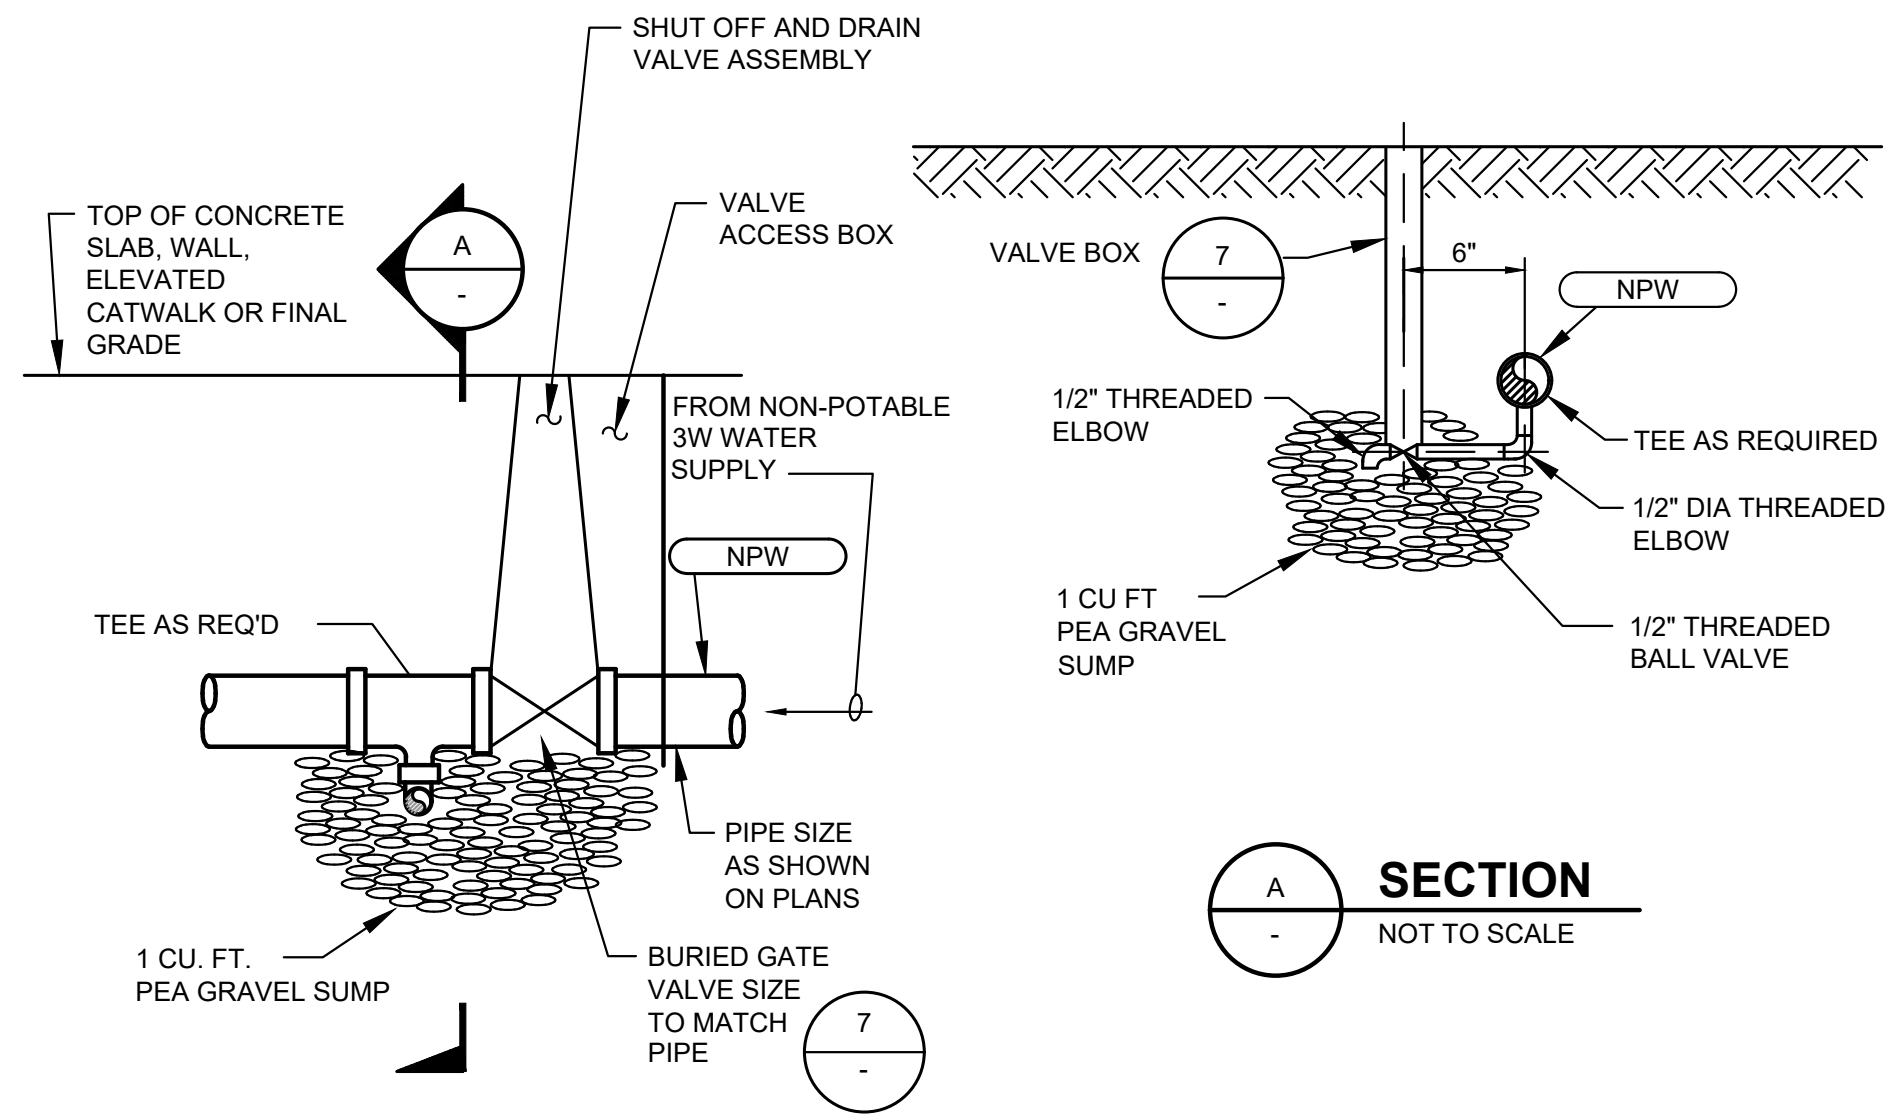

6 SHUT OFF DRAIN VALVE DETAIL
TYP NOT TO SCALE

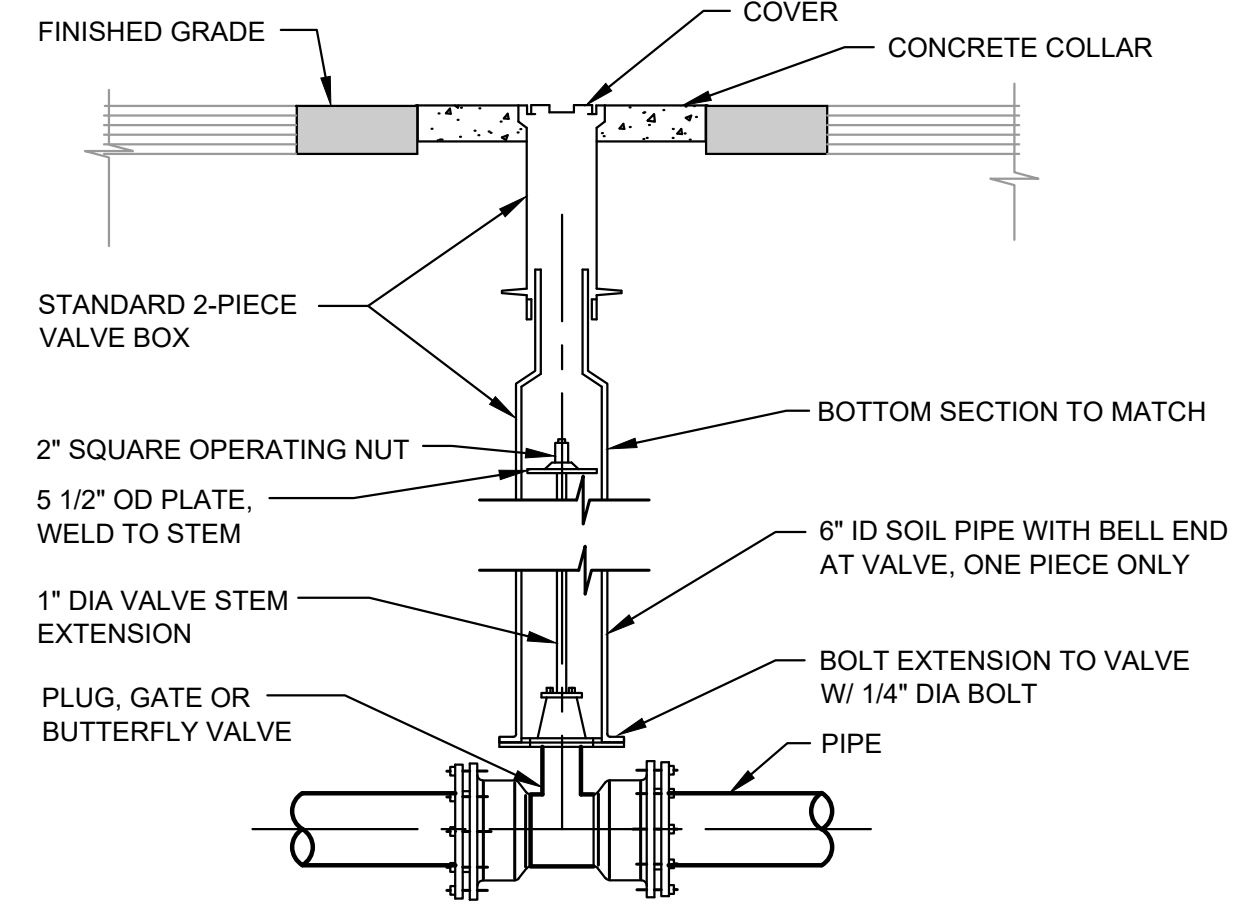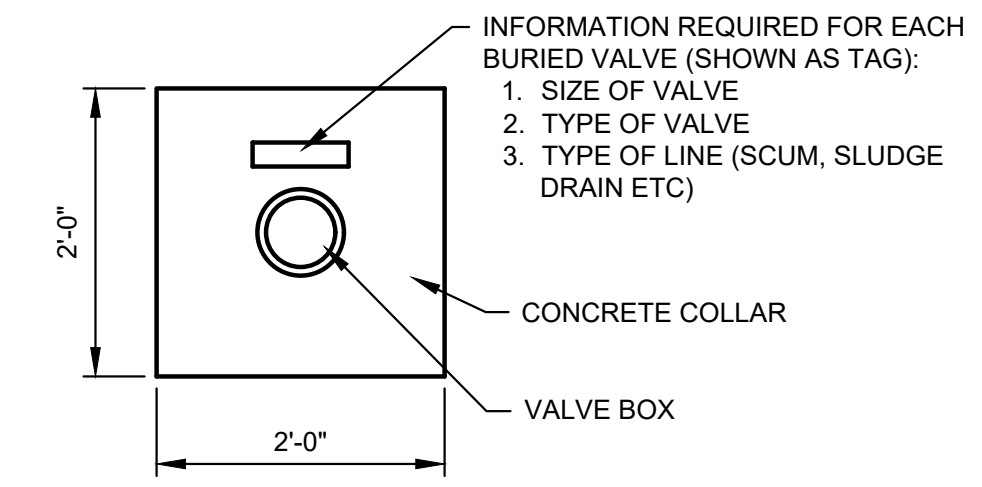

7 TYPICAL VALVE BOX DETAIL
TYP NOT TO SCALE

m:\PUYALLUP\21462 wpcp 3rd secondary clarifier\01 design\plan\set\General\GD_DET.dwg, 1/3/2022 1:14 PM, CHARLEY REID

m:\PUYALLUP\21462\wpcp\3rd_secondary\clarifier01_design\PlanSet\Mechanical\M_DET.dwg, 1/3/2022 1:57 PM, CHARLEY REID


PIPING SYMBOLS

DOUBLE LINE	SINGLE LINE	DESCRIPTION	DOUBLE LINE	SINGLE LINE	DESCRIPTION
		EXISTING PIPE			TEE
		NEW PIPE			TEE UP
		WELDED			TEE DOWN
		SCREWED JOINT			CROSS
		FLANGED			WYE
		MECHANICAL JOINT			BELL UP
		GROOVED COUPLING			FLEXIBLE HOSE OR TUBING
		FLANGED COUPLING ADAPTER			VALVE WITH MOTOR ACTUATOR
		FLANGED COUPLING ADAPTER W/ THRUST TIES TO NEXT FLANGED JOINT			SOLENOID VALVE
		FLEXIBLE COUPLING			DENOTES ITEMS TO BE SALVAGED OR DEMOLISHED BY CONTRACTOR IN ACCORDANCE WITH THE SPECIFICATIONS
		STAINLESS STEEL LOW PRESSURE AIR PIPE COUPLING			EXISTING PIPE TO BE DEMOLISHED BY THE CONTRACTOR IN ACCORDANCE WITH THE PLANS AND SPECIFICATIONS
		ADAPTOR FLANGE			EXISTING PIPE TO BE ABANDONED BY CONTRACTOR IN ACCORDANCE WITH THE SPECIFICATIONS
		UNION			
		RESTRAINED FLEXIBLE COUPLING			
		RUBBER EXPANSION JOINT			
		RESTRAINED RUBBER EXPANSION JOINT			
		BLIND FLANGE			
		CHECK VALVE			
		GATE VALVE			
		PLUG VALVE			
		BUTTERFLY VALVE			
		BALL VALVE			
		CONCENTRIC REDUCER			
		ECCENTRIC REDUCER			
		ELBOW, 45°			
		ELBOW, 90°			
		ELBOW UP			
		ELBOW DOWN			

NOTE:
FOR ADDITIONAL ABBREVIATIONS AND SYMBOLS SEE SHEETS G-3, S-1 AND E-1.


PROCESS PIPING, VALVE, GATE AND EQUIPMENT IDENTIFICATIONS

PROCESS PIPING

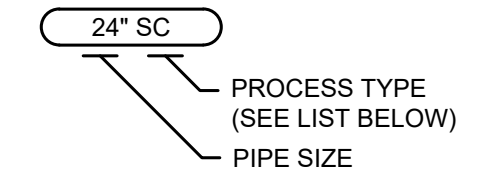


ABBREVIATION	PROCESS TYPE
D	DRAIN
FE	FINAL EFFLUENT
I	IRRIGATION
LUB	LUBRICATION
ML	MIXED LIQUOR
NPW	NON-POTABLE WATER
P	PRIMARY INFLUENT
PD	PROCESS DRAIN
RAS	RETURN ACTIVATED SLUDGE
RS	RAW SEWAGE
SAM	SAMPLE
SC	SCUM
SD	STORM DRAIN
SE	SECONDARY EFFLUENT
SS	SANITARY SEWER
W	POTABLE WATER
WAS	WASTE ACTIVATED SLUDGE

EQUIPMENT

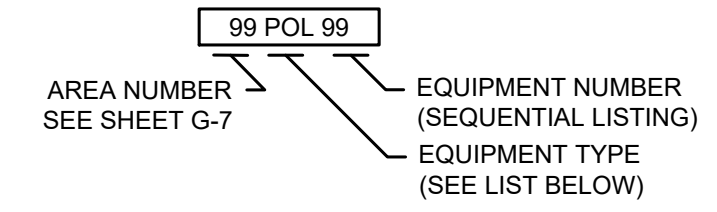

ABBREVIATION	EQUIPMENT TYPE
AG	AIR GAP UNIT
EF	EFFLUENT FLOW METER
ILA	INTERFACE LEVEL ANALYZER
MFM	MAGNETIC FLOW METER
RP	RETURN ACTIVATED SLUDGE PUMP
RLS	RADAR LEVEL SENSOR
SCM	SECONDARY CLARIFIER MECHANISM
TH	TROLLEY HOIST
WP	WASTE ACTIVATED SLUDGE PUMP

VALVES AND GATES

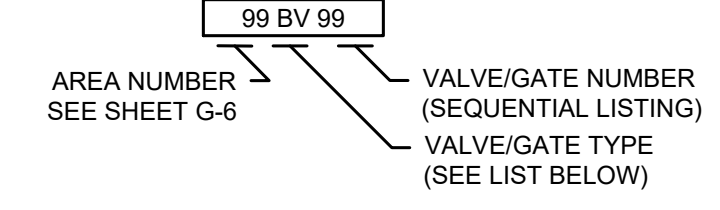

ABBREVIATION	VALVE TYPE
AV	AIR RELEASE VALVE
BLV	BALL VALVE
CV	CHECK VALVE
GV	GATE VALVE
MV	MUD VALVE
PV	PLUG VALVE
SG	SLIDE GATE
SLG	SLUICE GATE

NOTE:
FOR ADDITIONAL EQUIPMENT IDENTIFICATION SEE SHEET E-1.

Gray & Osborne, Inc.
CONSULTING ENGINEERS
1130 RAINIER AVENUE SOUTH, SUITE 300
SEATTLE, WASHINGTON 98144
(206) 284-0860



CITY OF PUYALLUP
WATER POLLUTION CONTROL PLANT THIRD SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

PRELIMINARY NOT FOR CONSTRUCTION

No.	DATE	REVISION

ISSUED FOR: 90% DESIGN REVIEW

ISSUE DATE: DECEMBER 2021

APPROVED BY: XXX


CHECKED BY: XXX

DRAWN BY: XXX

DESIGNER: XXX

G & O JOB NO.: 21462

FILE: M_DET.DWG



APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP


APPROVED DATE: _____

EXPIRATION DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

MECHANICAL

ABBREVIATIONS, SYMBOLS AND EQUIPMENT IDENTIFICATIONS

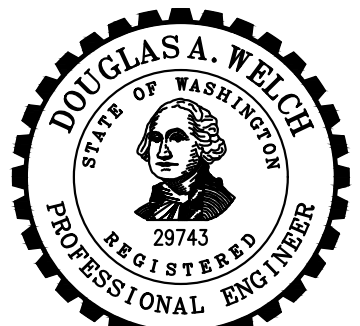

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION

ISSUED FOR:
90% DESIGN REVIEW
ISSUE DATE: DECEMBER 2021
APPROVED BY: XXX
CHECKED BY: XXX
DRAWN BY: XXX
DESIGNER: XXX
G & O JOB NO.: 21462
FILE: M_DET.DWG






MECHANICAL



APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED DATE: _____
EXPIRATION DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

PIPE DETAILS


DRAWING: **M-2** OF: **4**

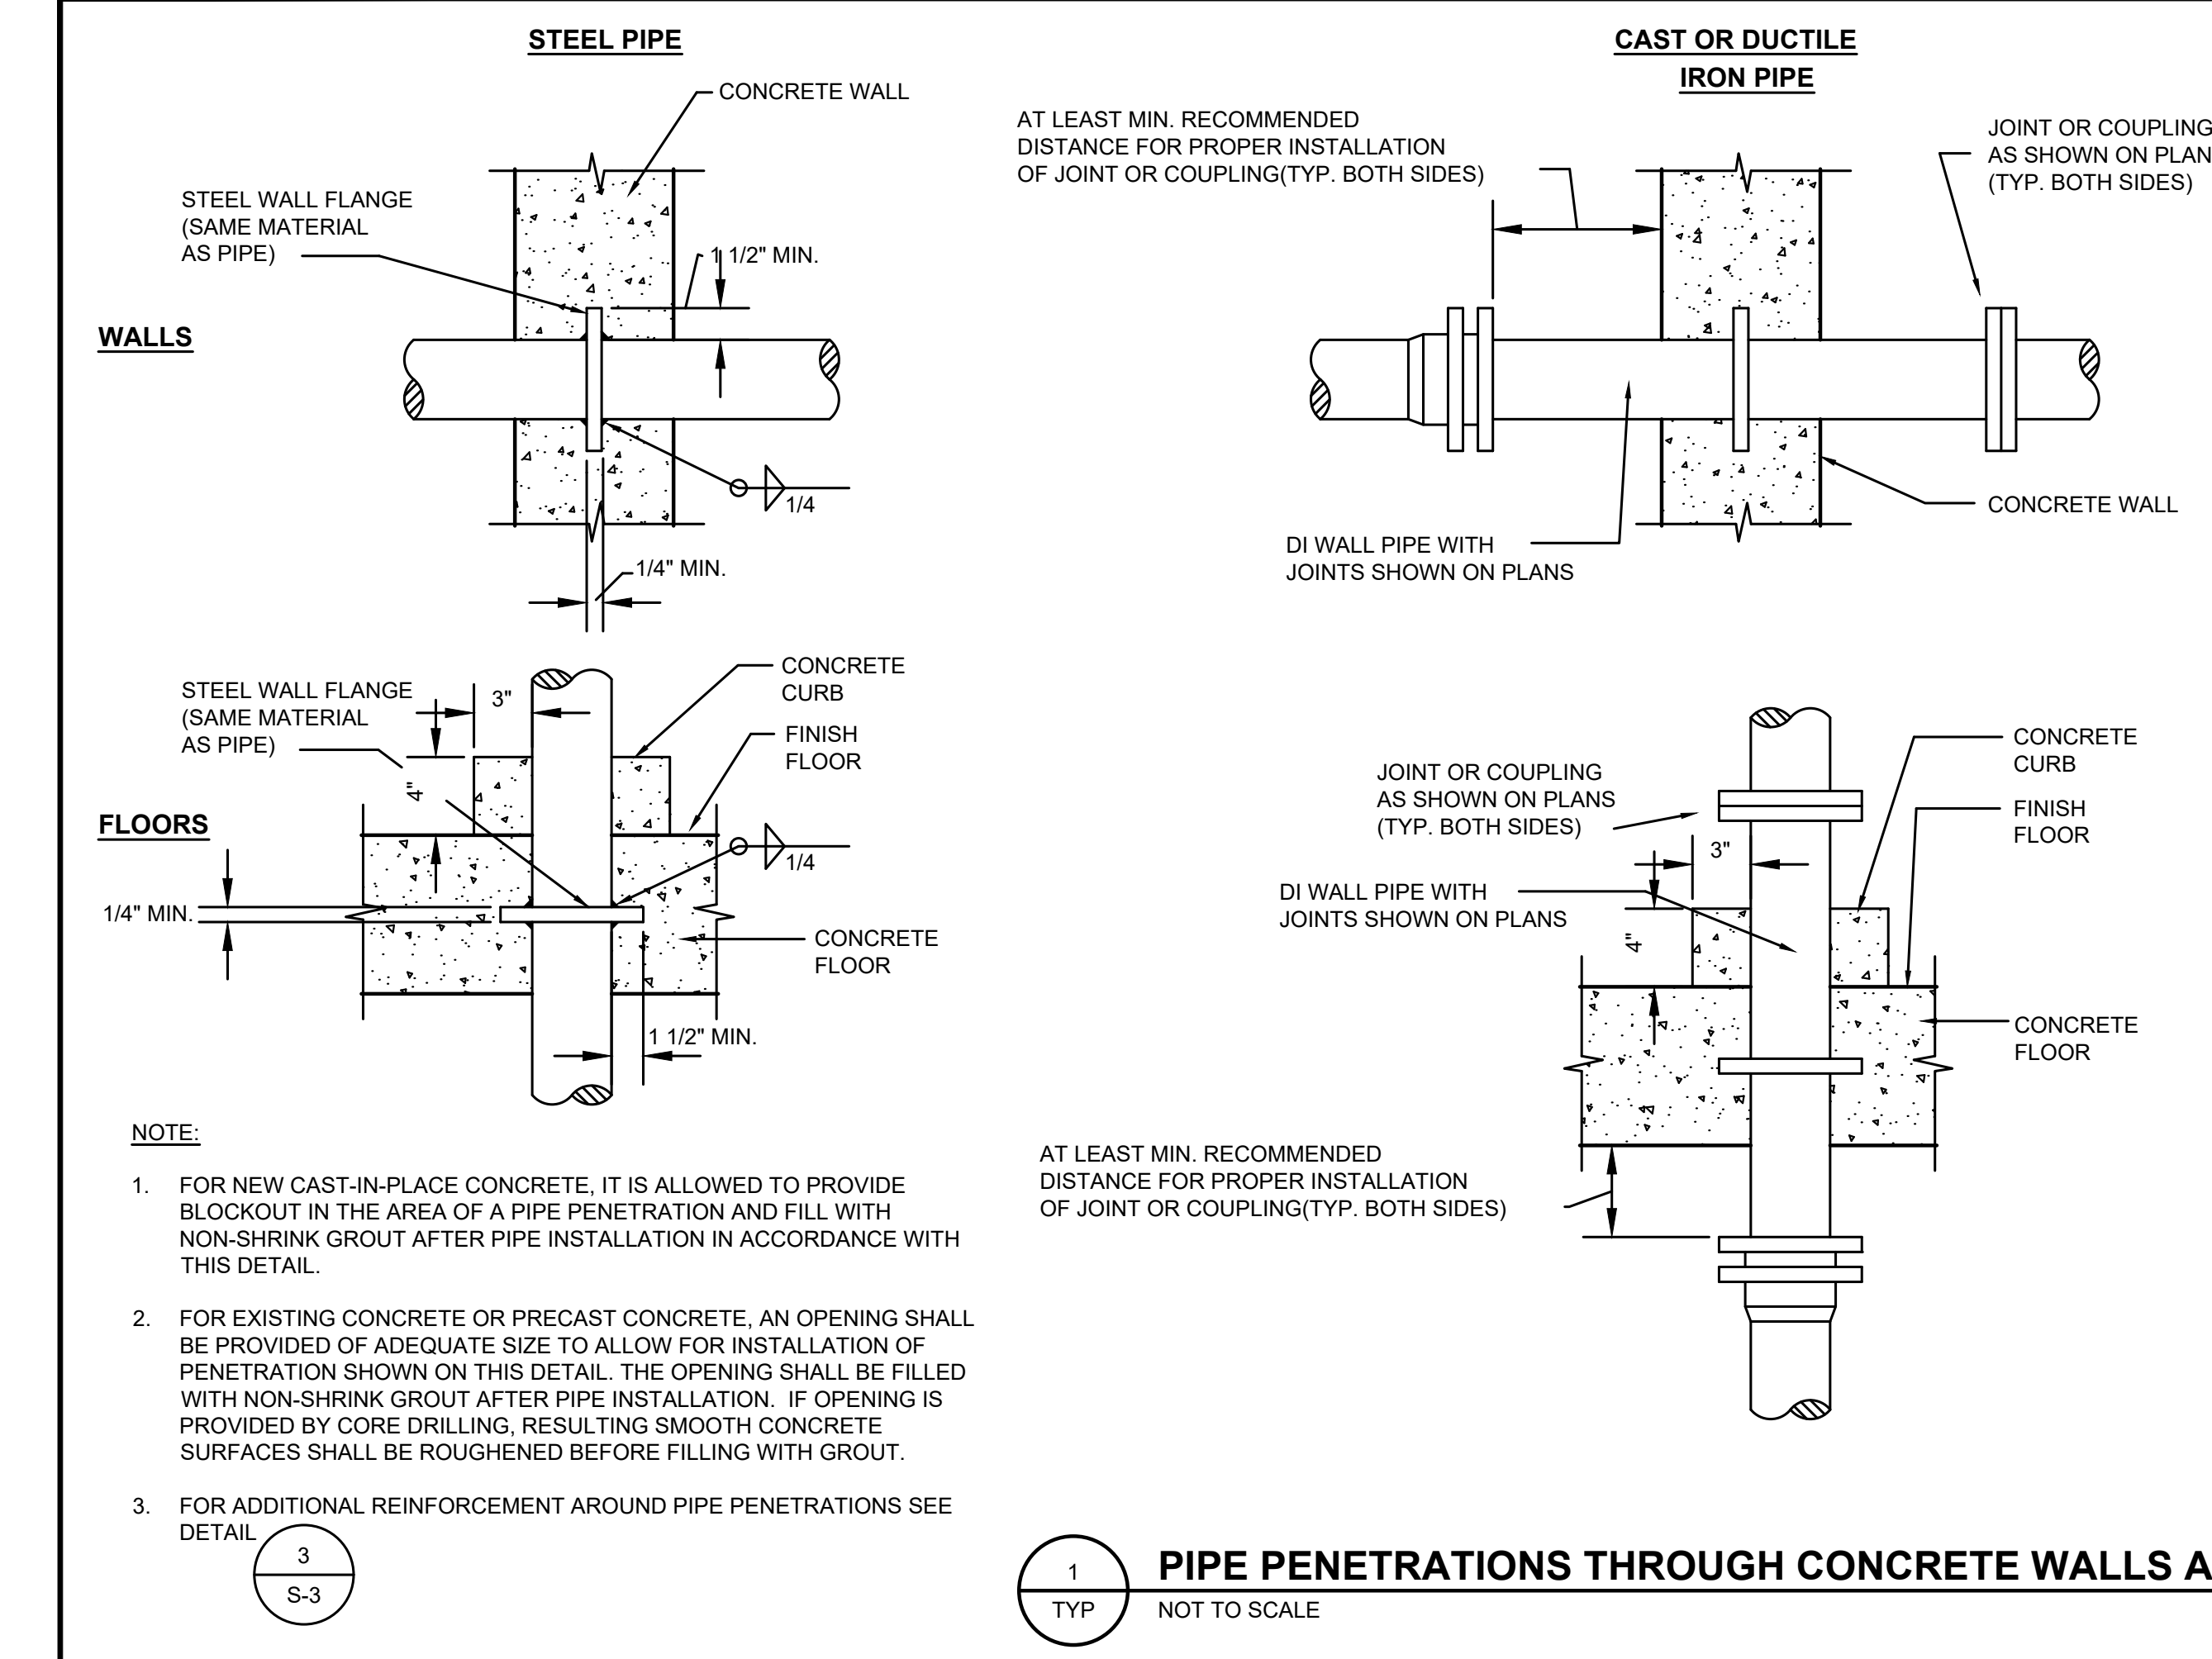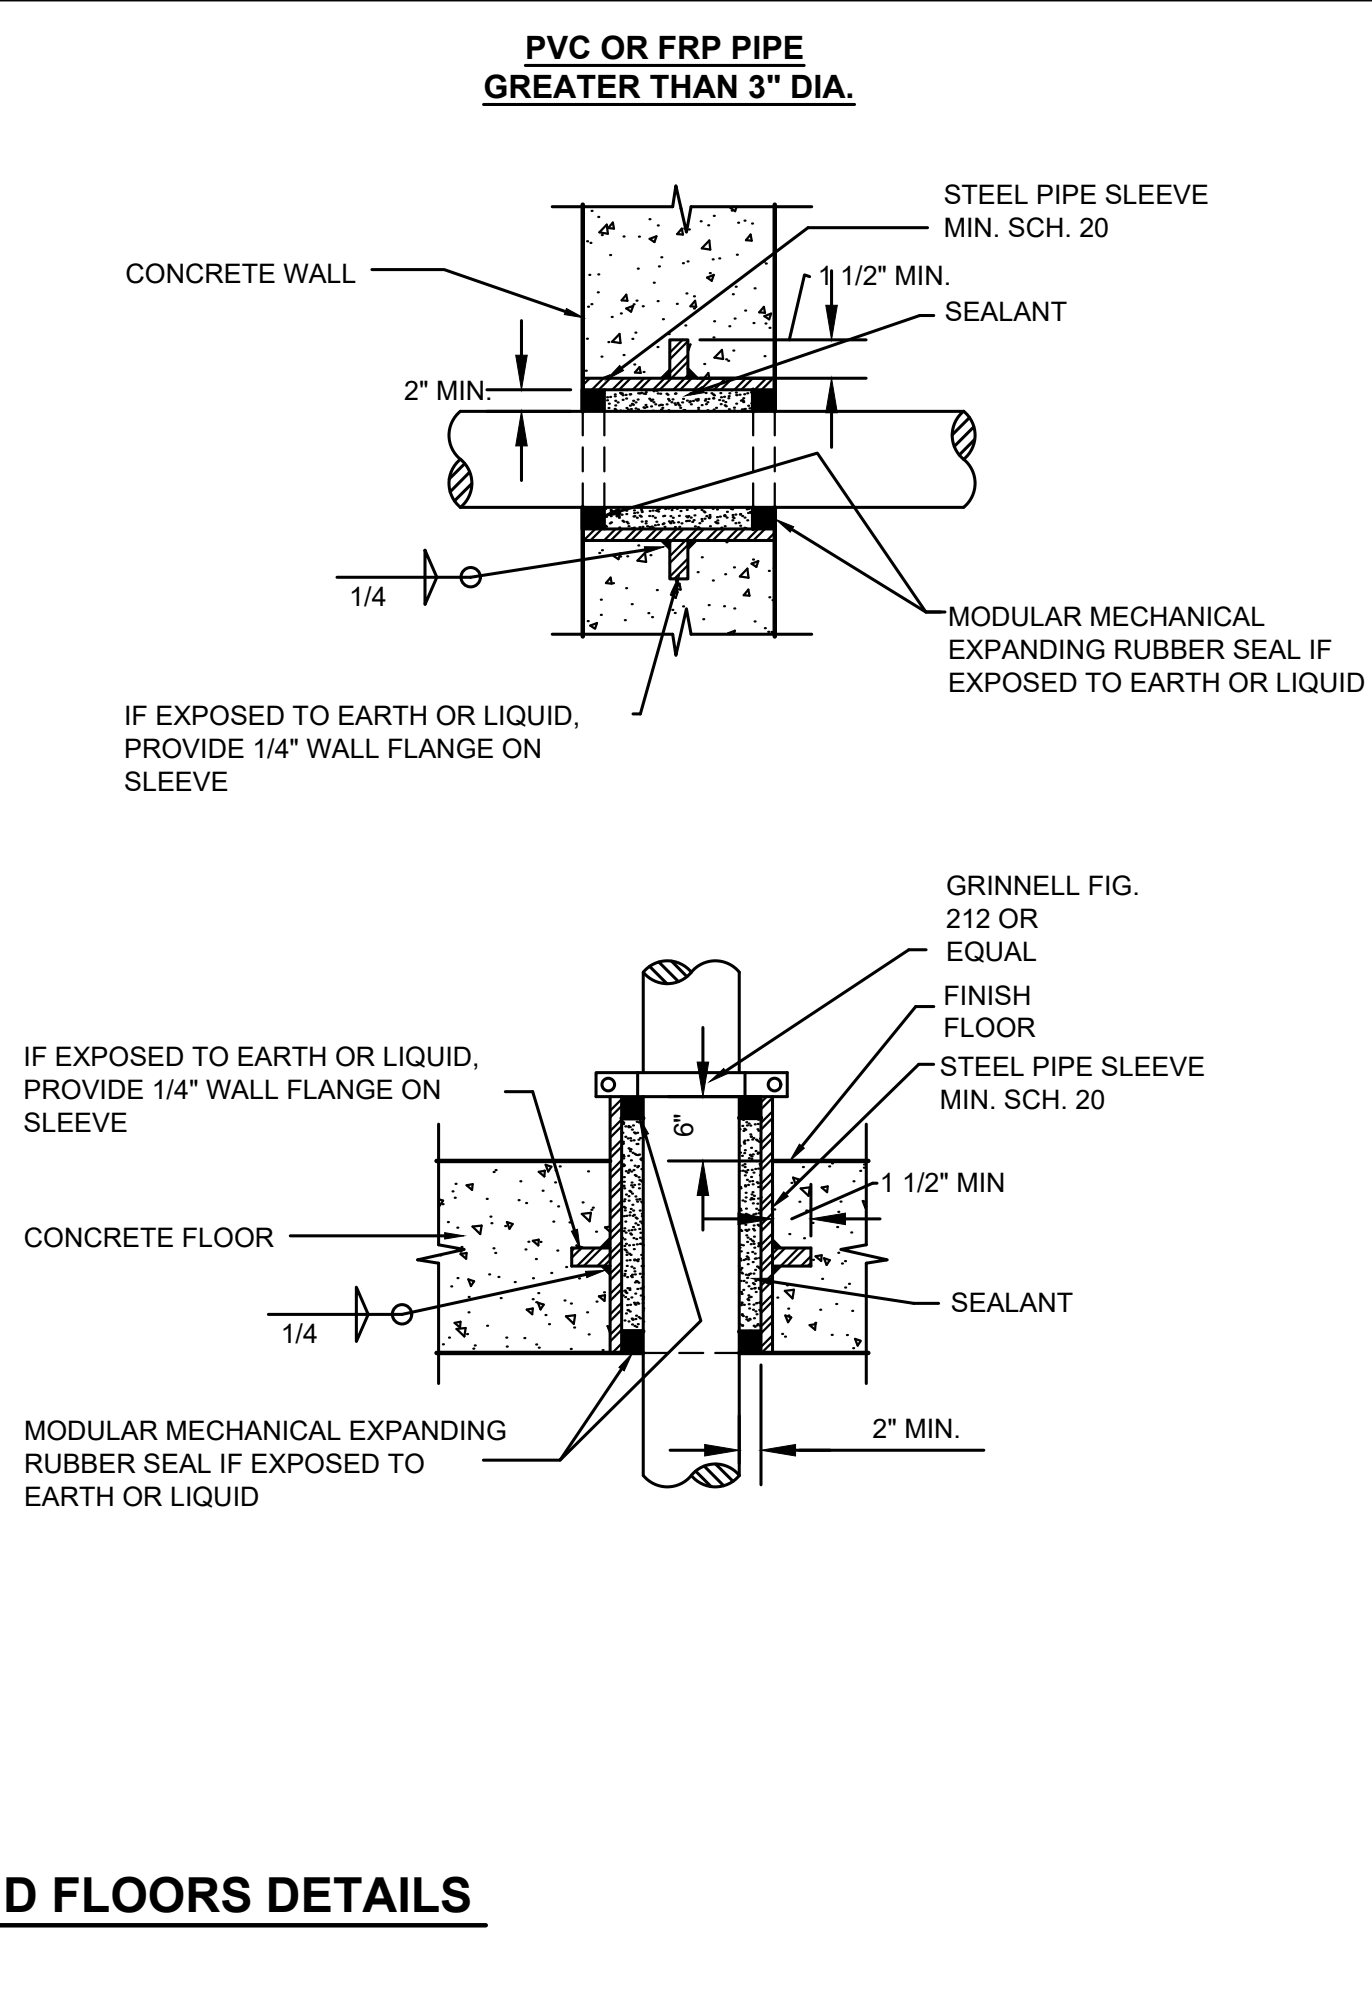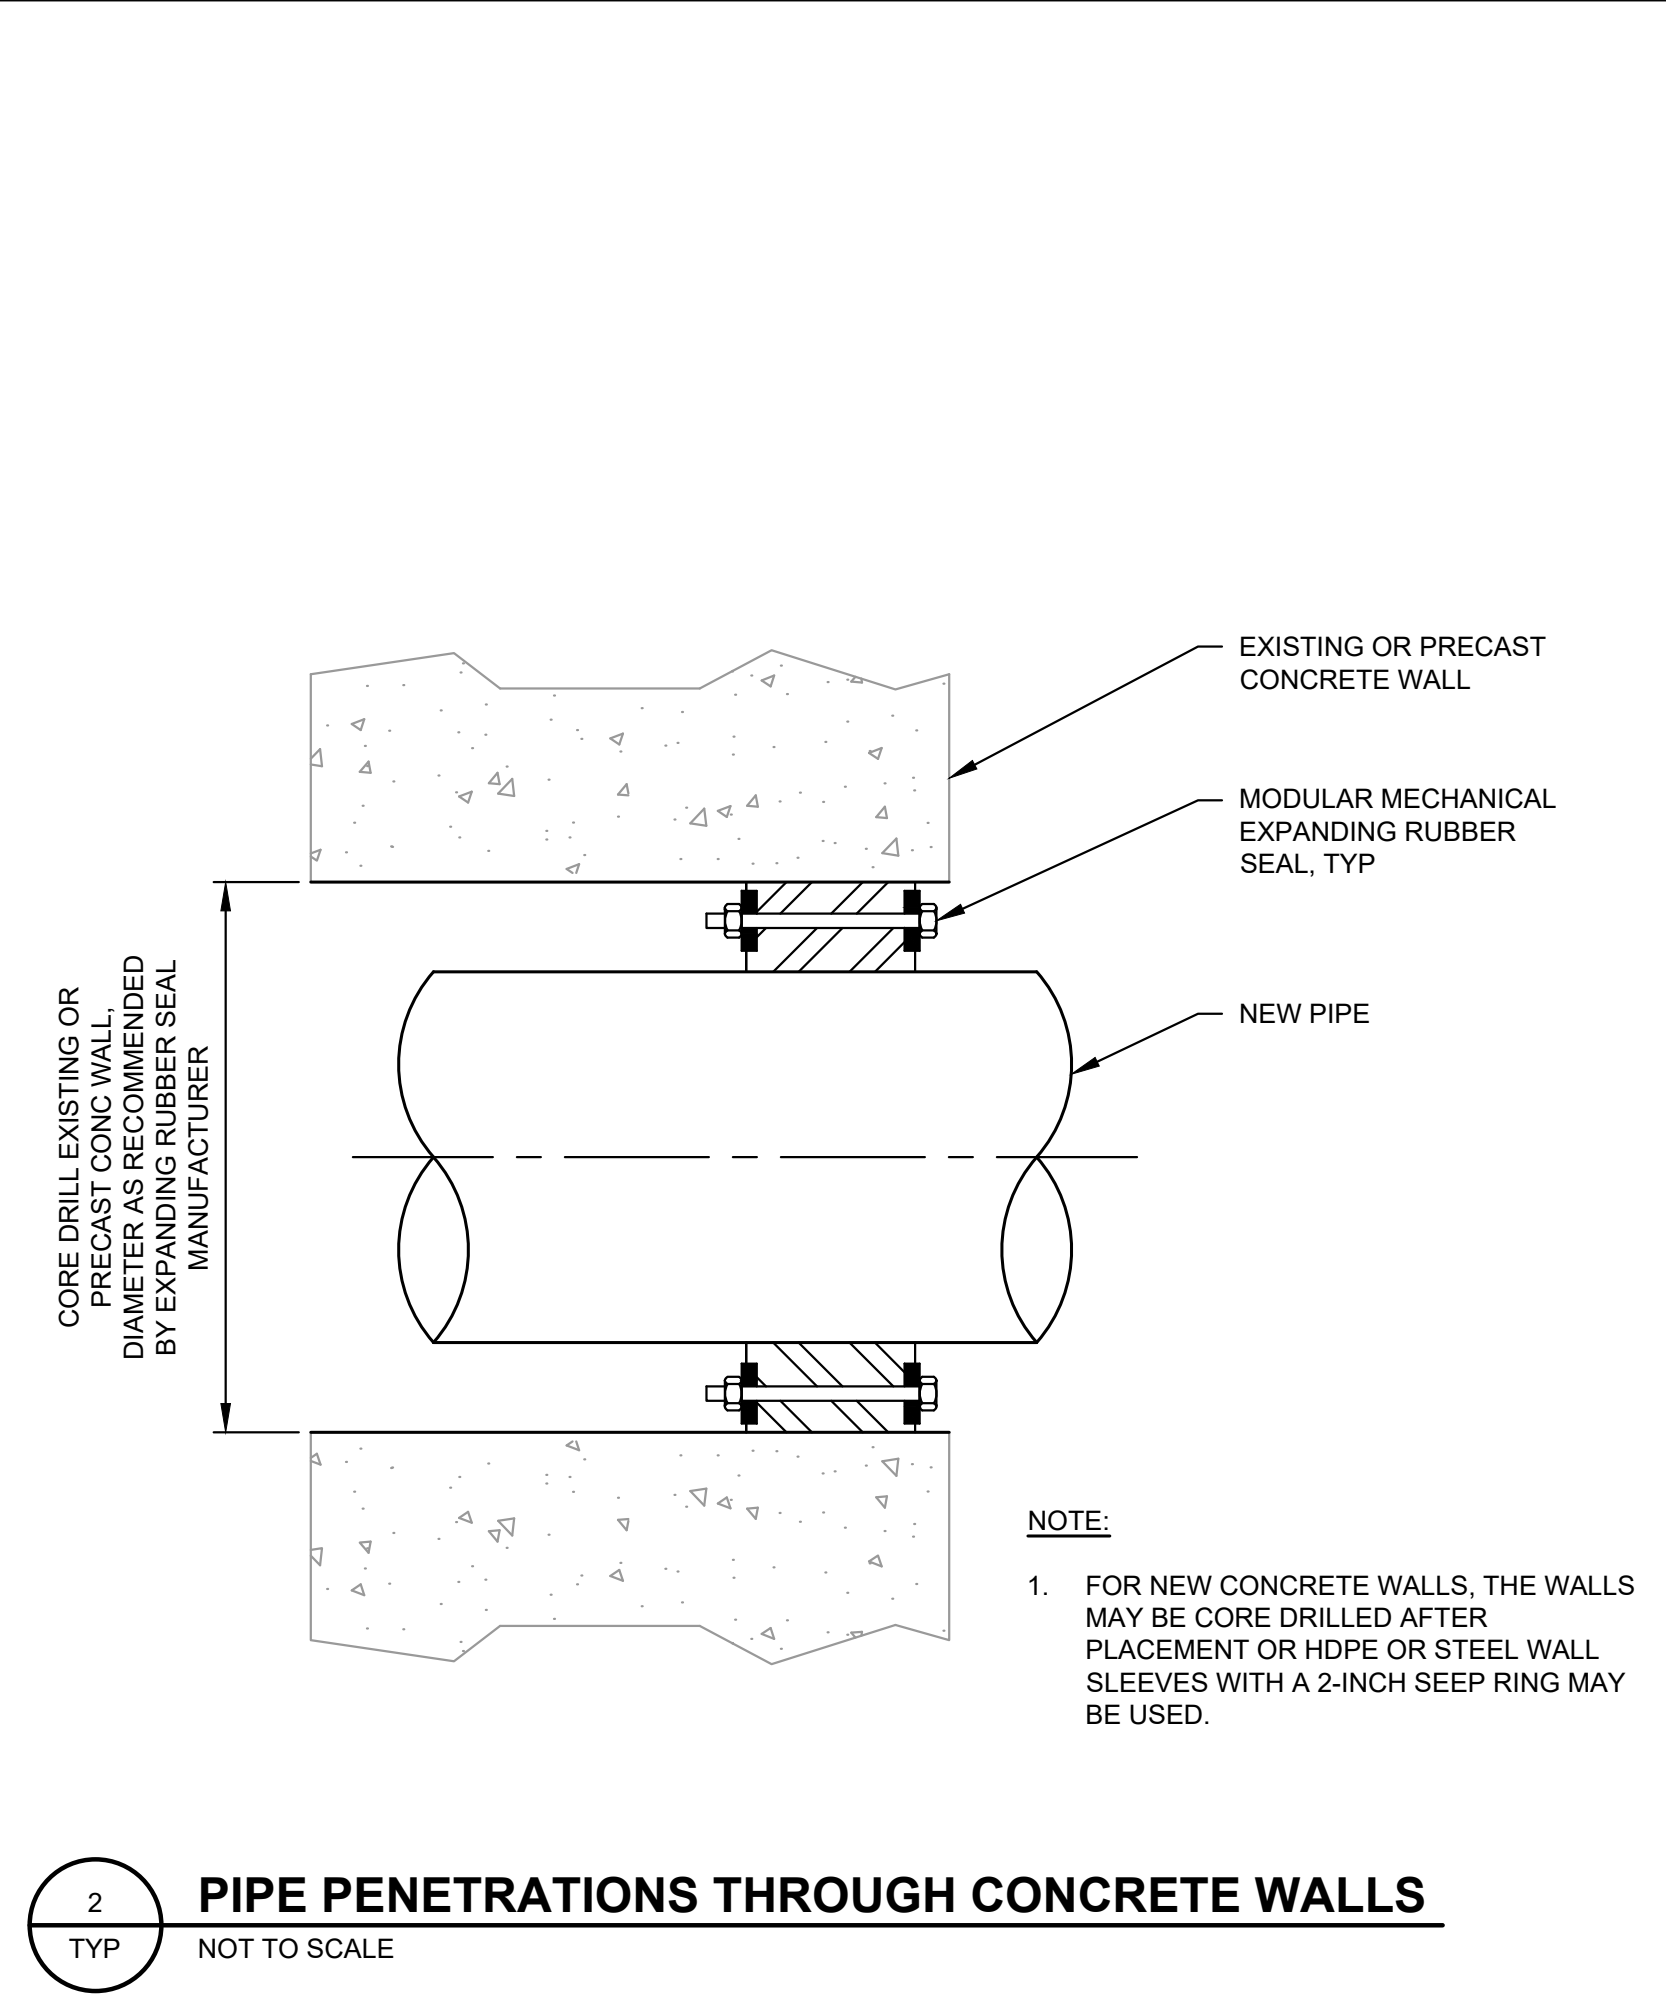

PIPE DIAMETER	NUMBER OF RODS	ROD DIAMETER	A	B	E	HB	HF	T	t	W
3"	2	5/8"	-	-	-	-	-	-	-	-
4"	2	5/8"	-	-	-	-	-	-	-	-
6"	2	5/8"	-	-	-	-	-	-	-	-
8"	2	5/8"	-	-	-	-	-	-	-	-
10"	2	5/8"	-	-	-	-	-	-	-	-
12"	2	5/8"	-	-	-	-	-	-	-	-
14"	2	5/8"	5"	2 3/8"	3"	3 7/8"	2"	3/8"	0.188"	1 3/8"
16"	2	5/8"	5"	2 3/8"	3"	3 7/8"	2"	3/8"	0.188"	1 3/8"
18"	2	5/8"	5"	3"	3"	3 7/8"	2"	3/8"	0.188"	1 3/8"
20"	2	5/8"	5"	3 1/4"	3"	3 7/8"	2"	3/8"	0.188"	1 3/8"
24"	2	3/4"	5"	3 7/8"	3 1/8"	4 1/8"	2"	3/8"	0.188"	1 1/2"
30"	4	3/4"	5"	4 3/4"	3 1/8"	4 1/8"	2"	3/8"	0.188"	1 1/2"
36"	4	7/8"	5 1/2"	5 5/8"	3 1/8"	4 1/4"	2"	1/2"	0.188"	1 5/8"
42"	4	1"	5 3/4"	6 1/2"	3 1/4"	4 1/2"	2"	1/2"	0.188"	1 3/4"

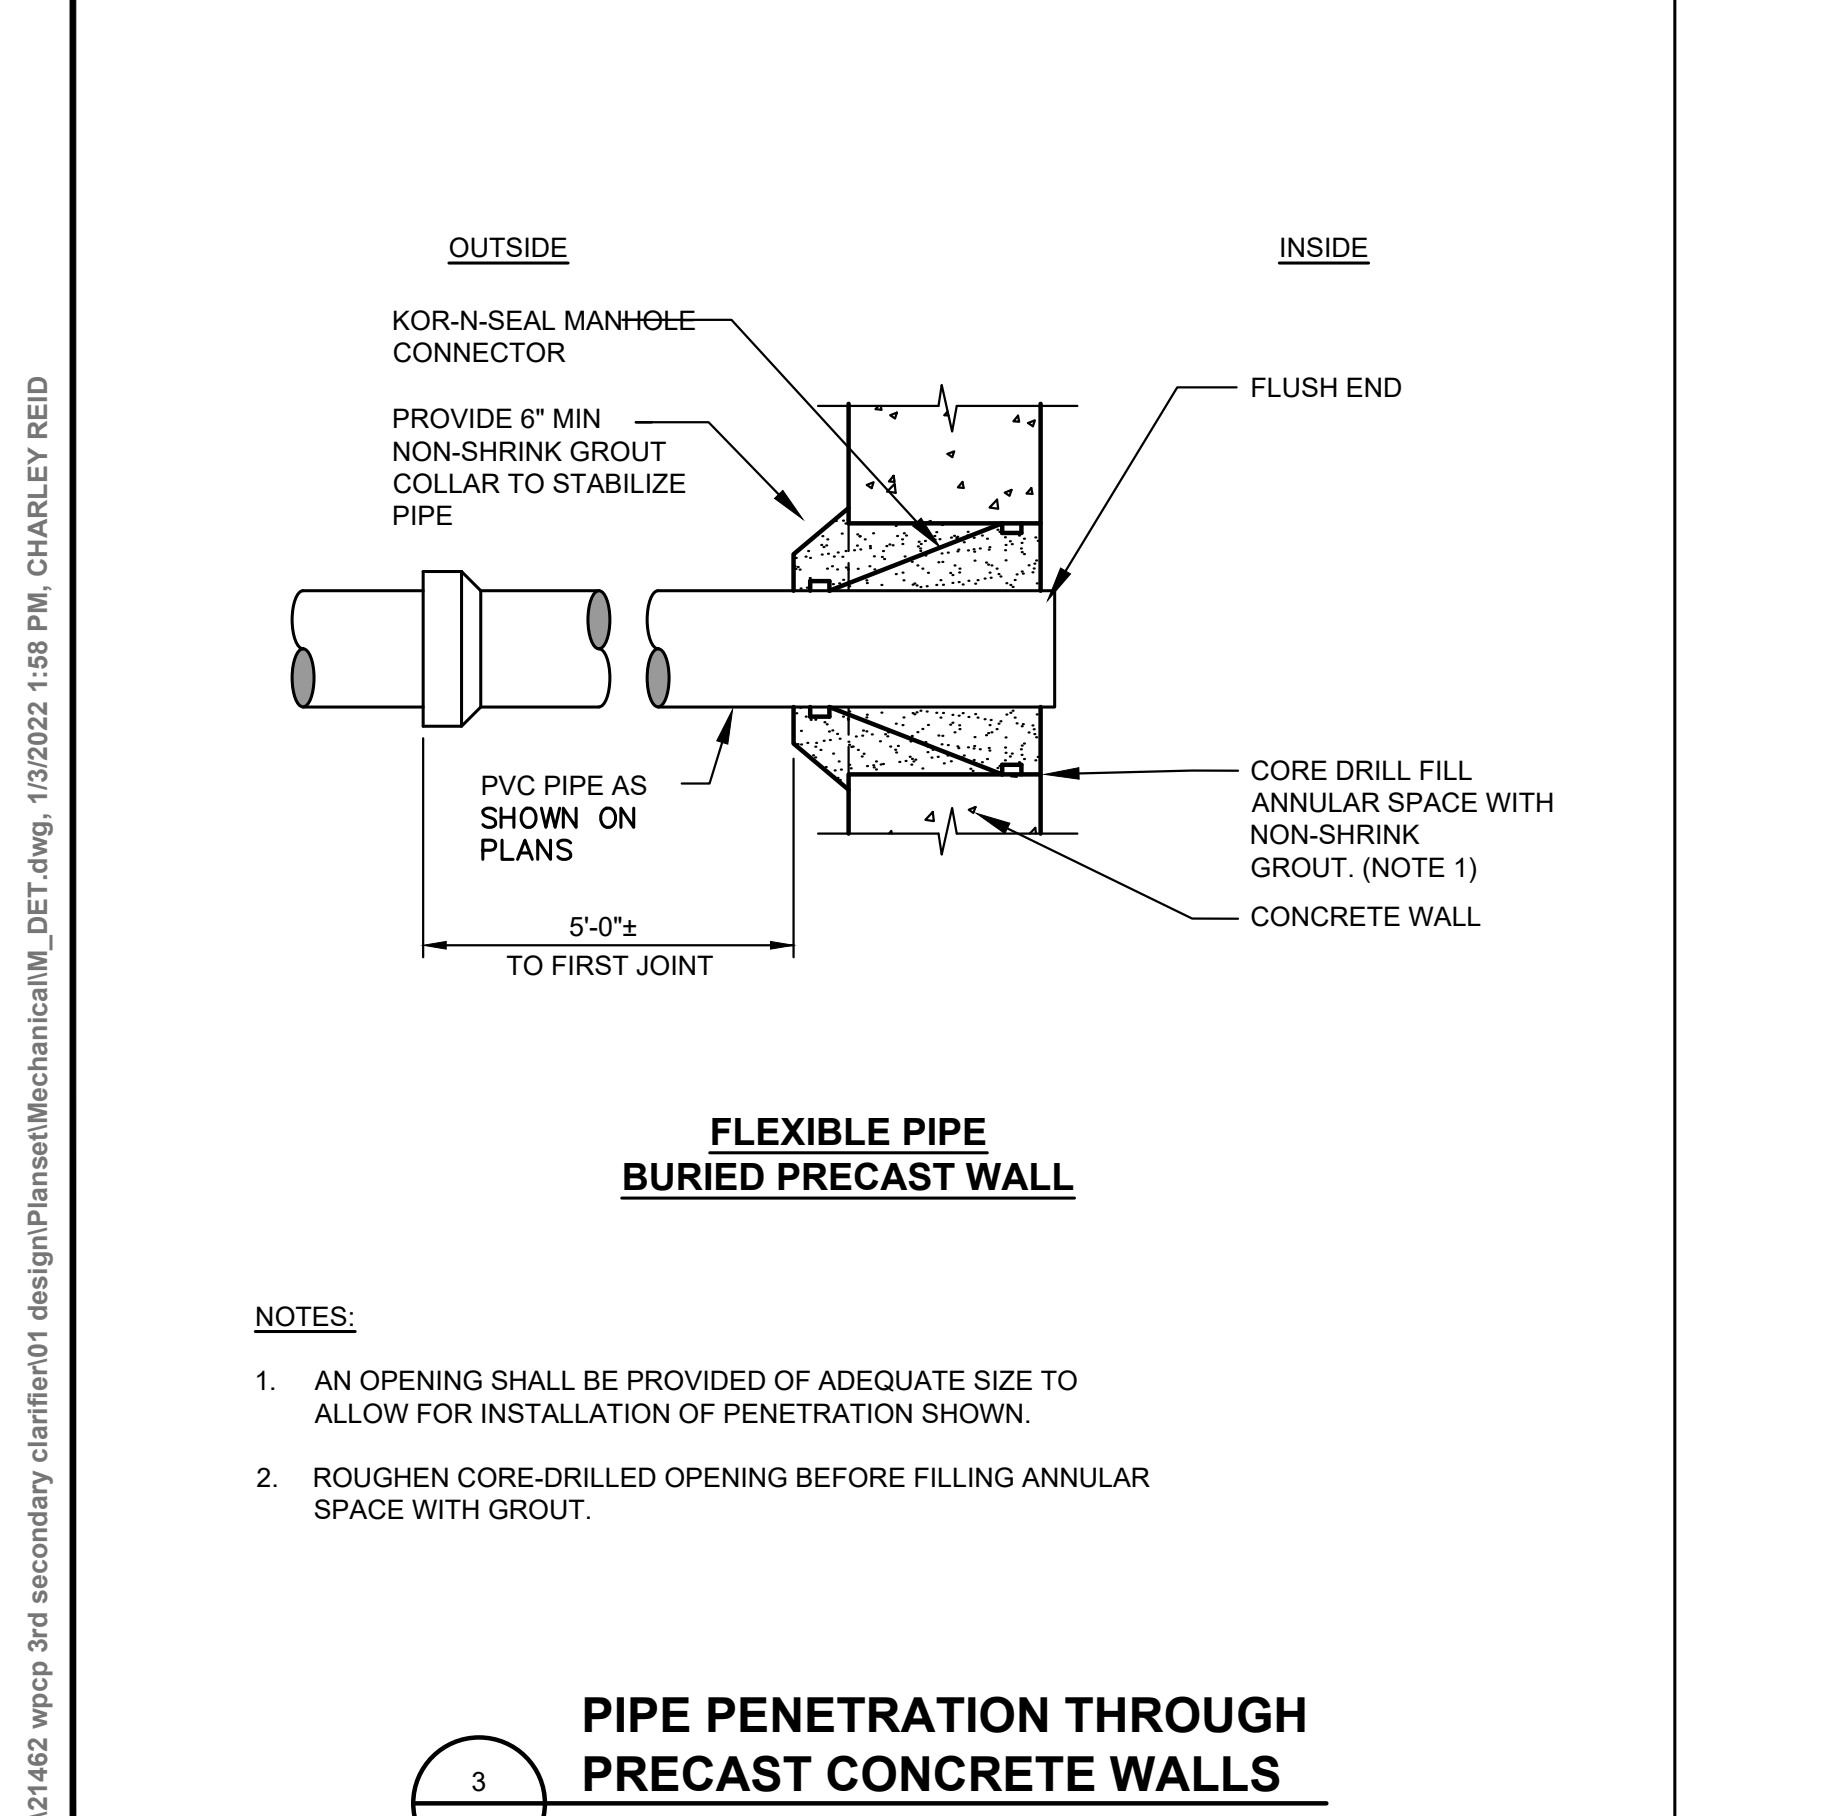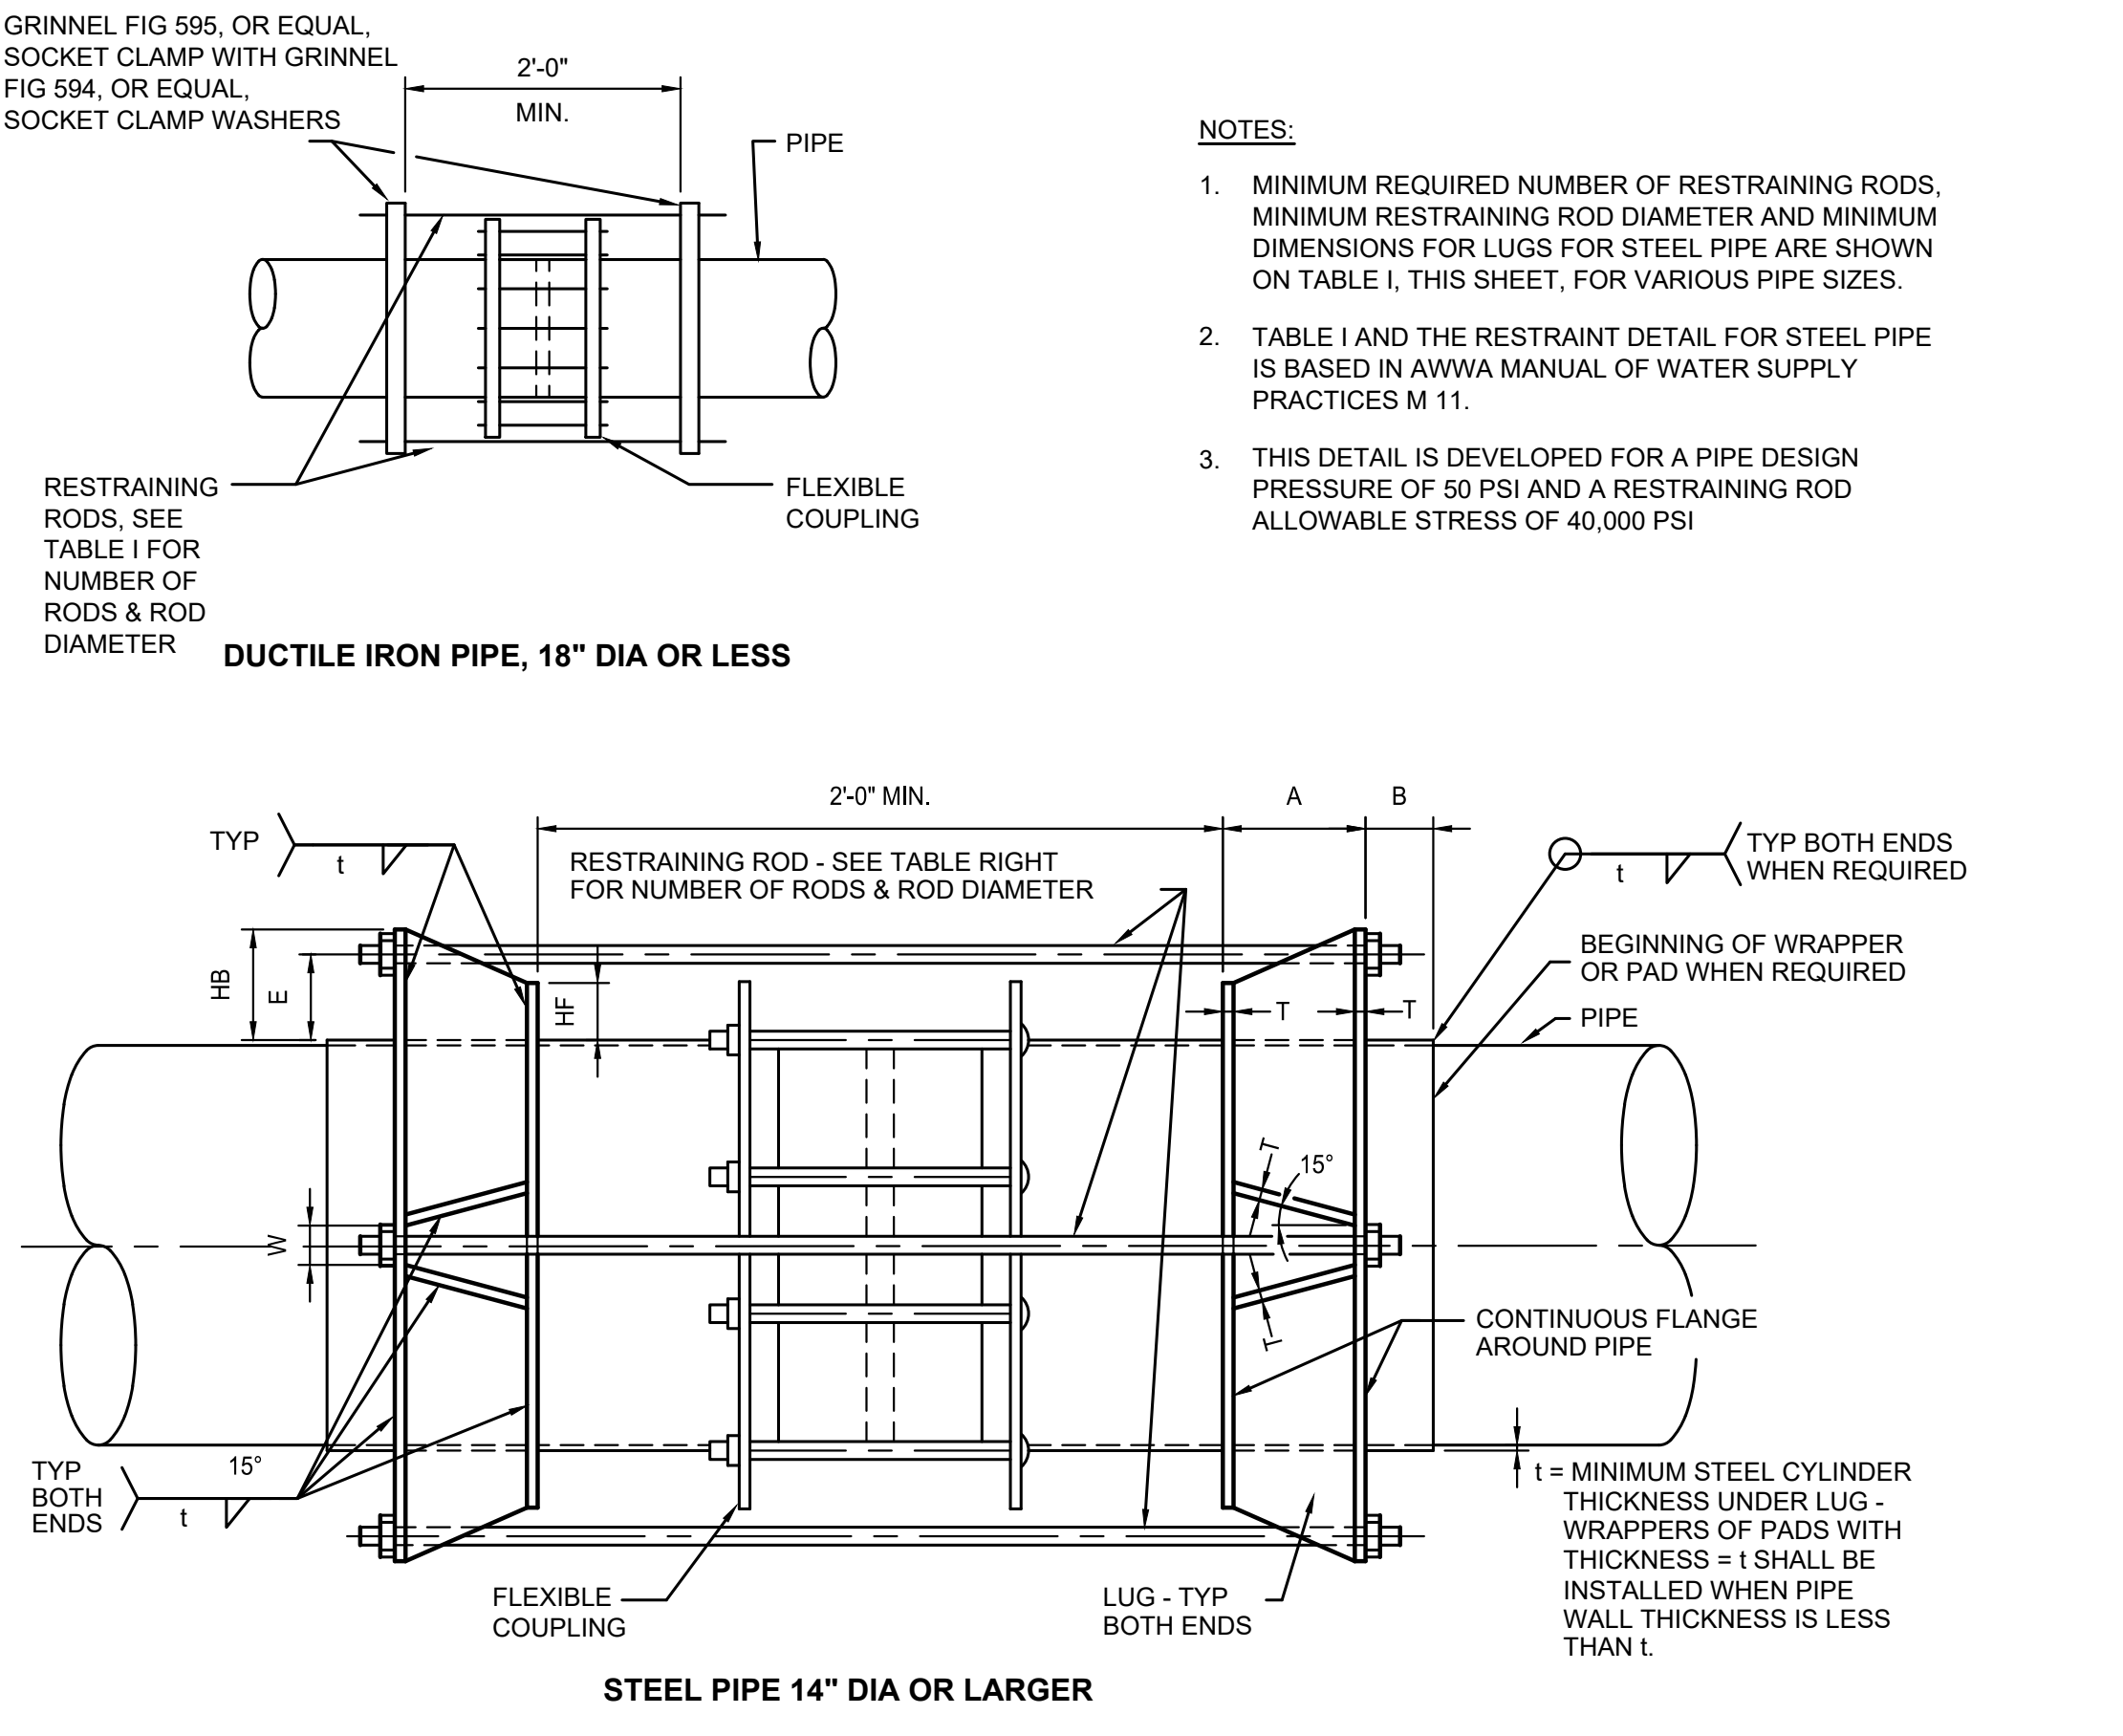


m:\PUYALLUP\21462\wpcp\3rd_secondary\clarifier01_design\Plan\set\Mechanical\M_DET.dwg, 1/3/2022 1:58 PM, CHARLEY REID

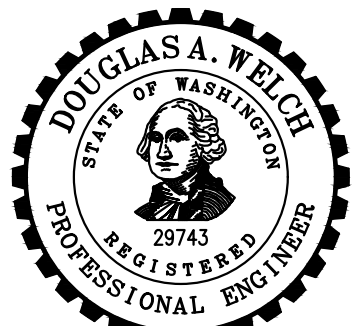

PRELIMINARY
NOT FOR
CONSTRUCTION

No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: XXX		
CHECKED BY: XXX		
DRAWN BY: XXX		
DESIGNER: XXX		
G & O JOB NO.: 21462		
FILE: M_DET.DWG		



MECHANICAL

APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP

APPROVED
DATE: _____


EXPIRATION
DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.


The City will not be responsible for errors and/or omissions on these plans.

Field conditions may dictate changes to these plans as determined by the City Engineer.


MISCELLANEOUS
DETAILS

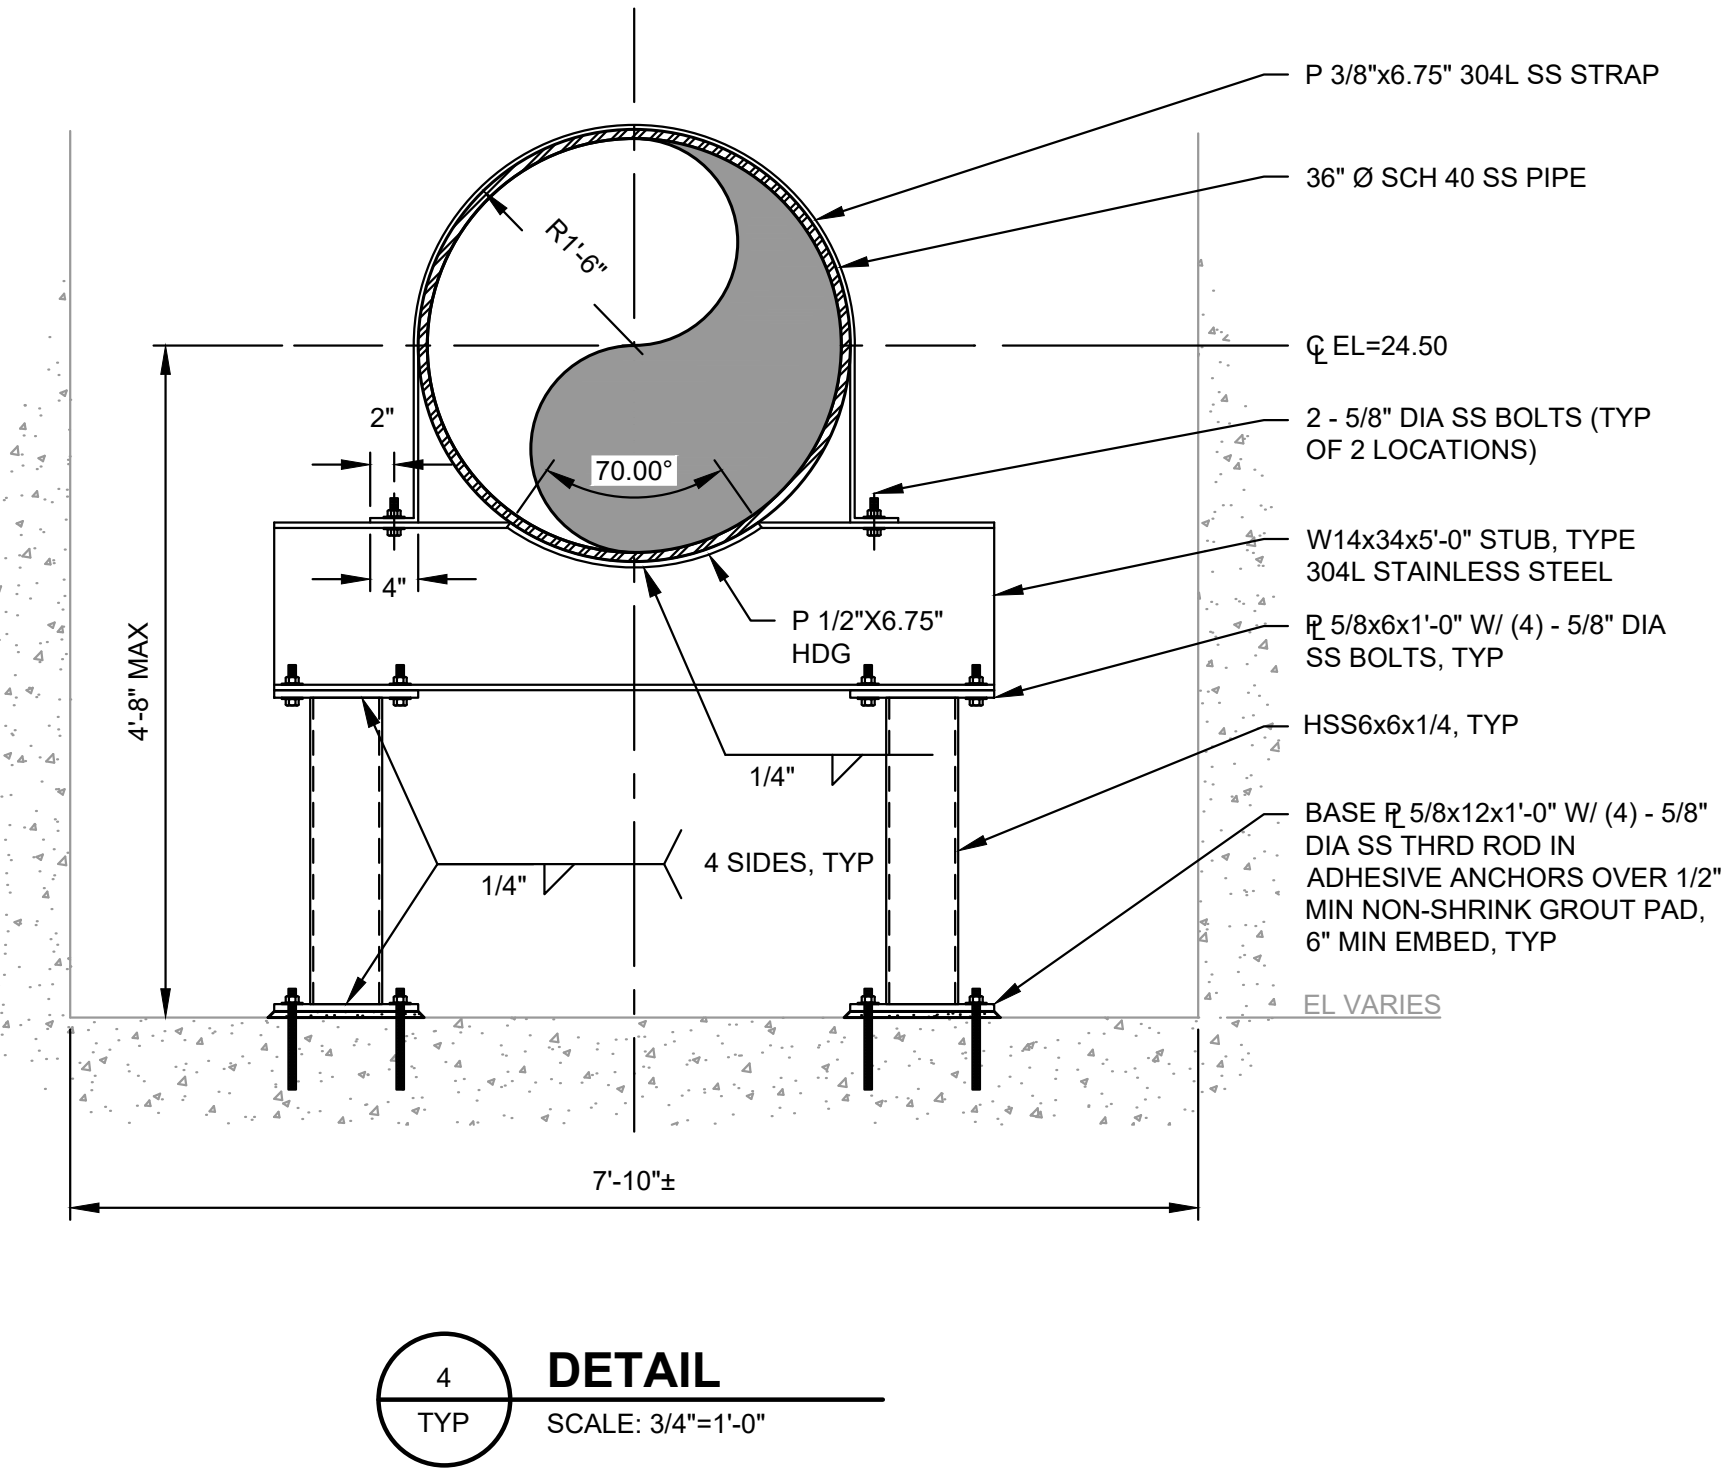


4
TYP SCALE: 3/4"=1'-0"

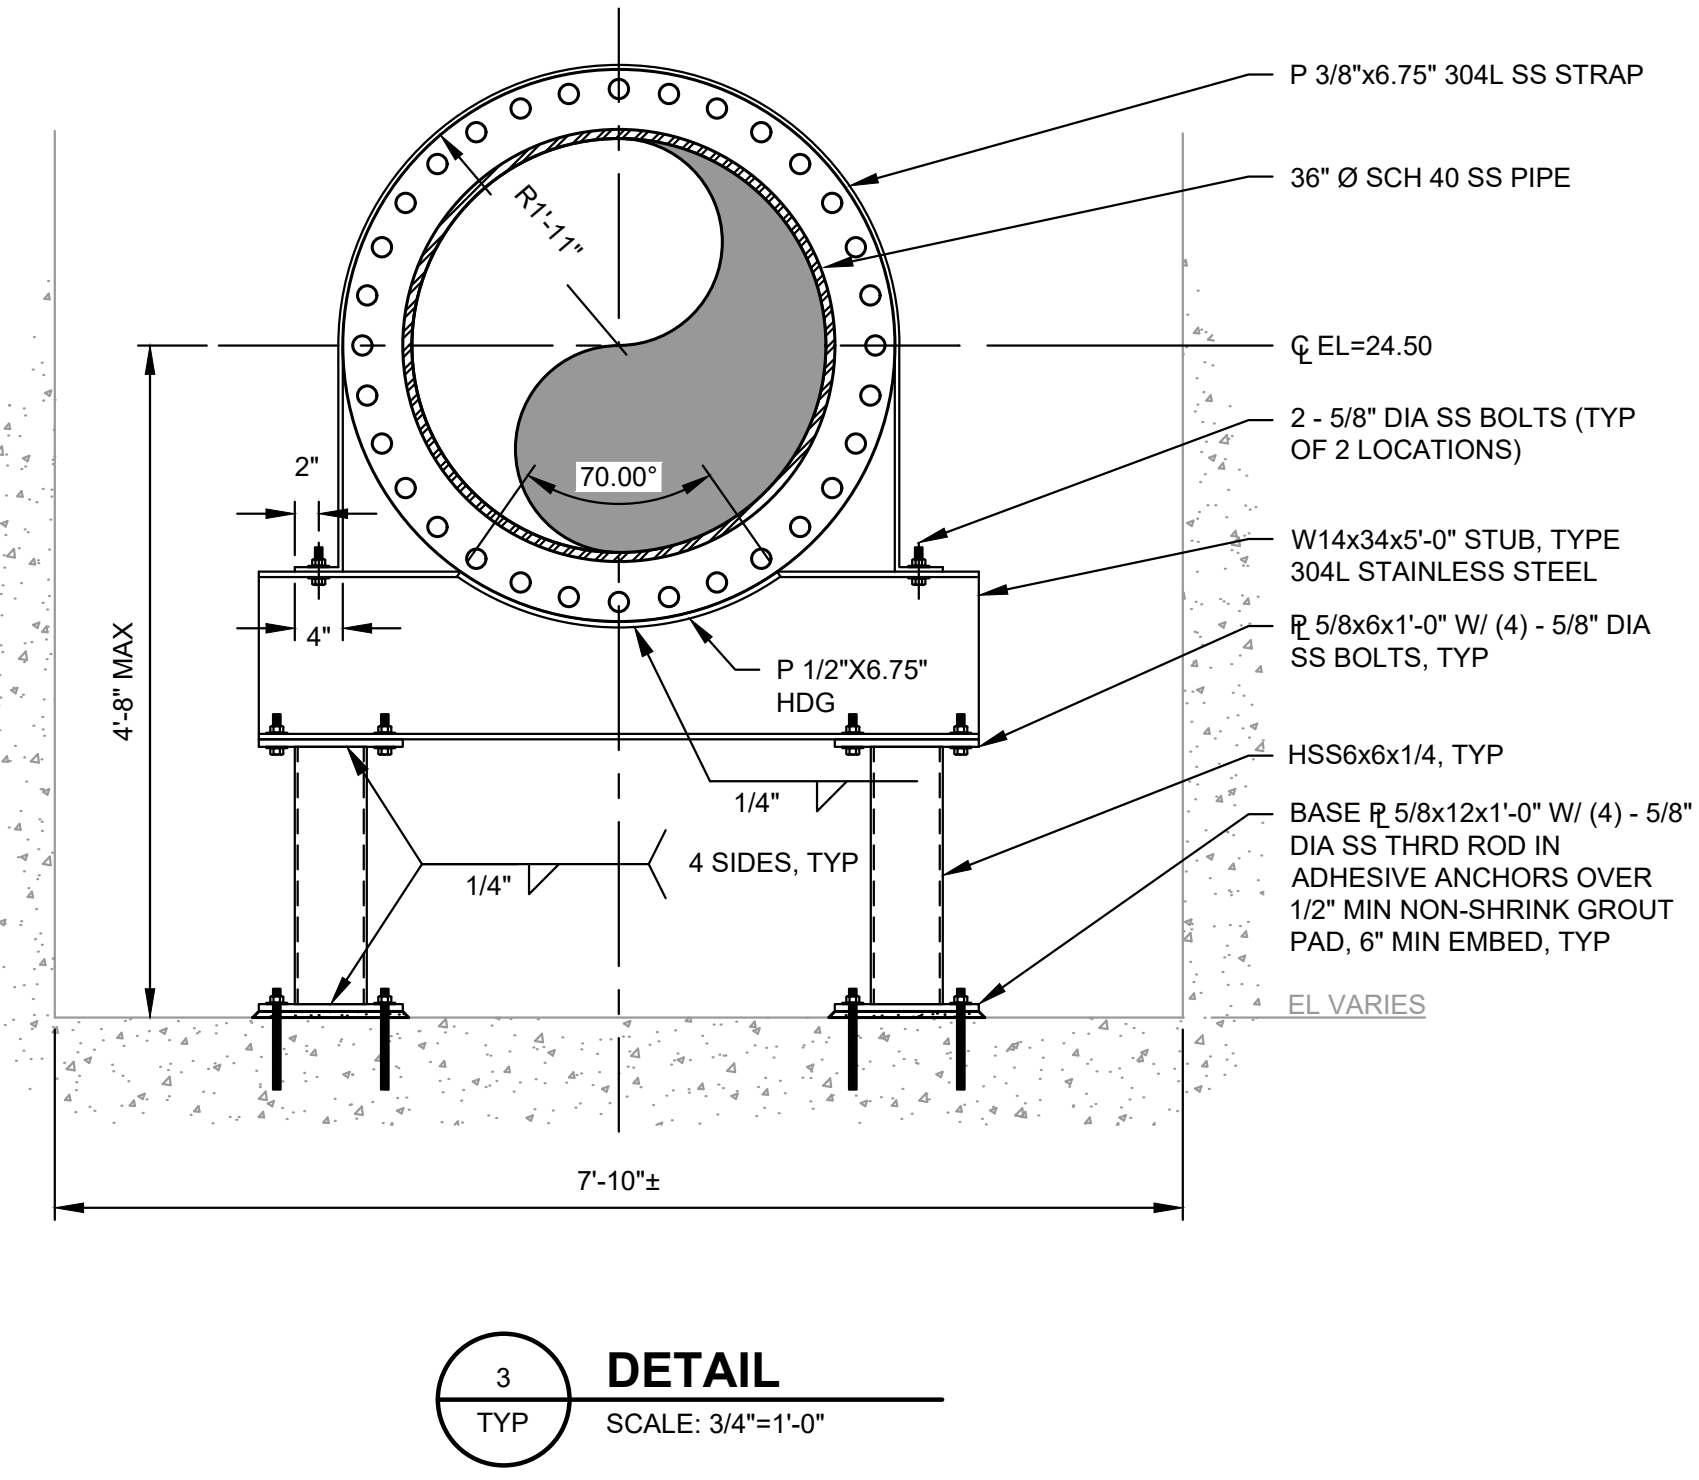


3
TYP SCALE: 3/4"=1'-0"

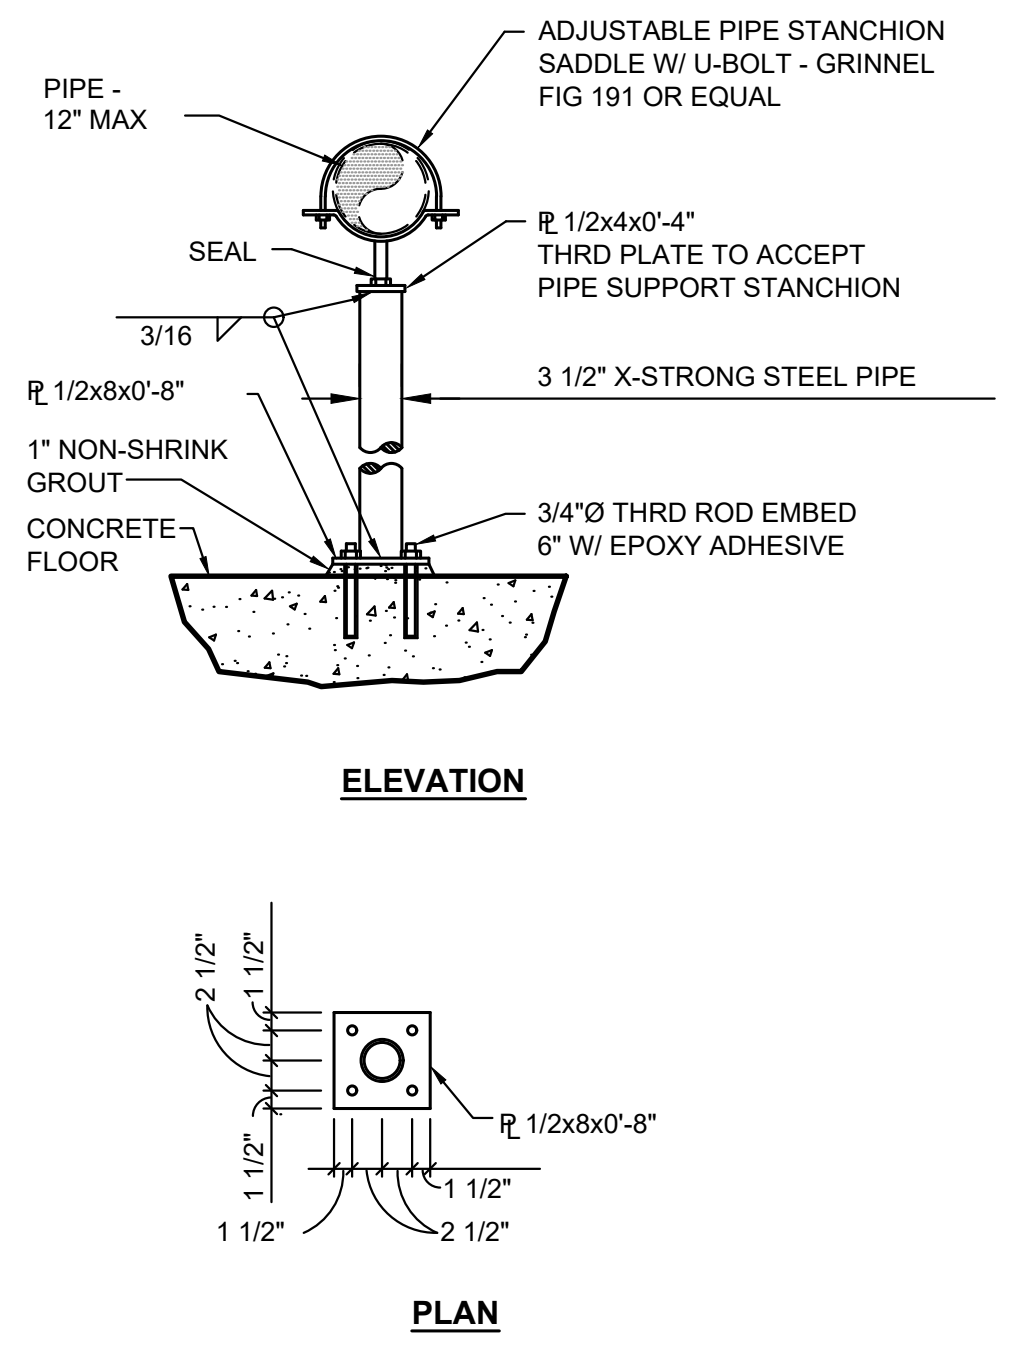


2
TYP NOT TO SCALE

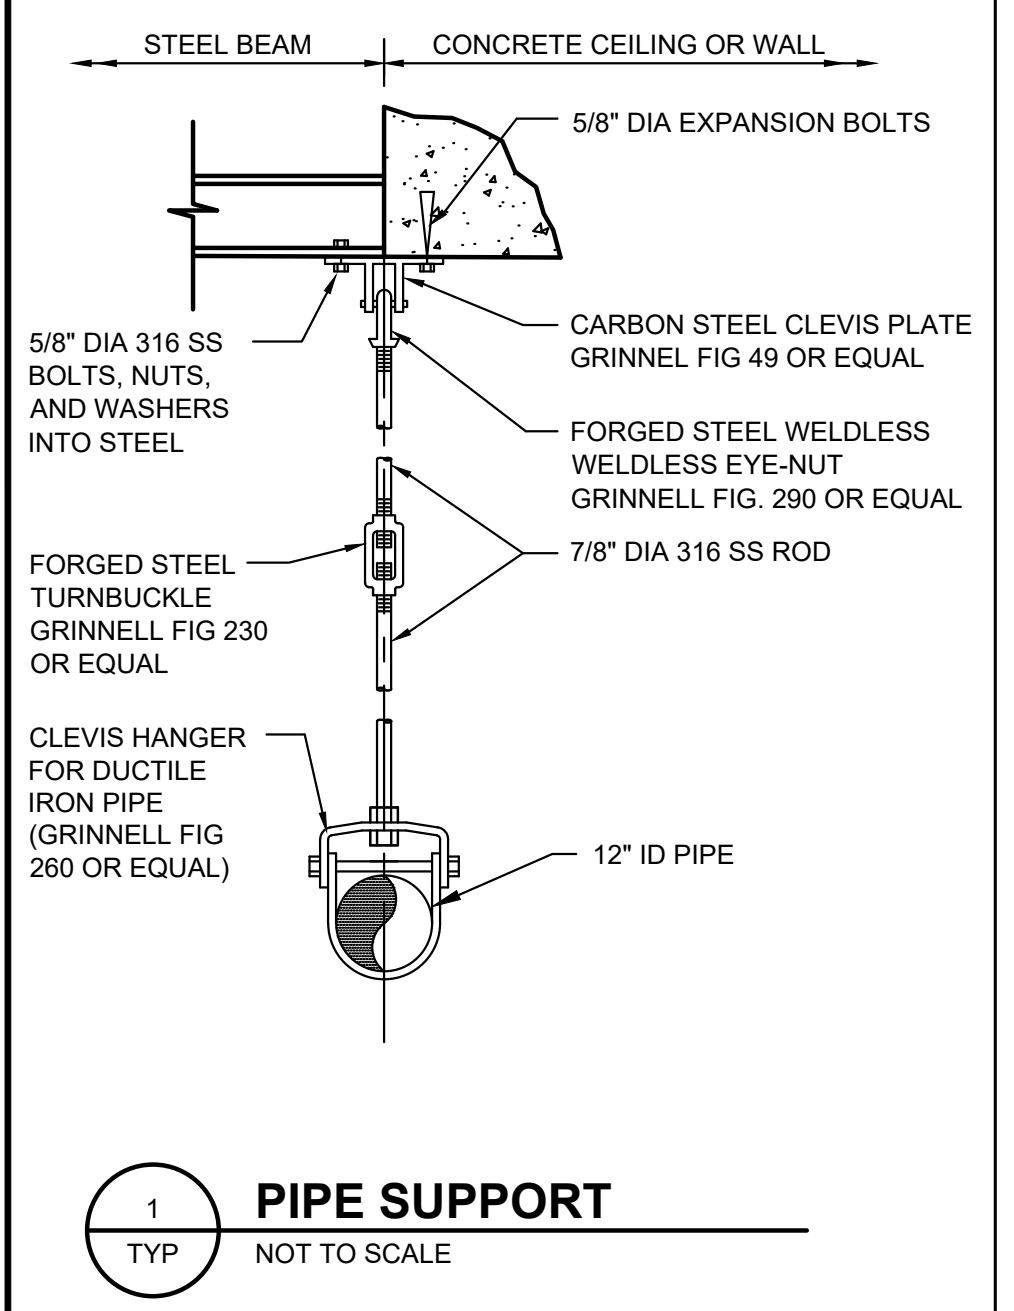


1
TYP NOT TO SCALE

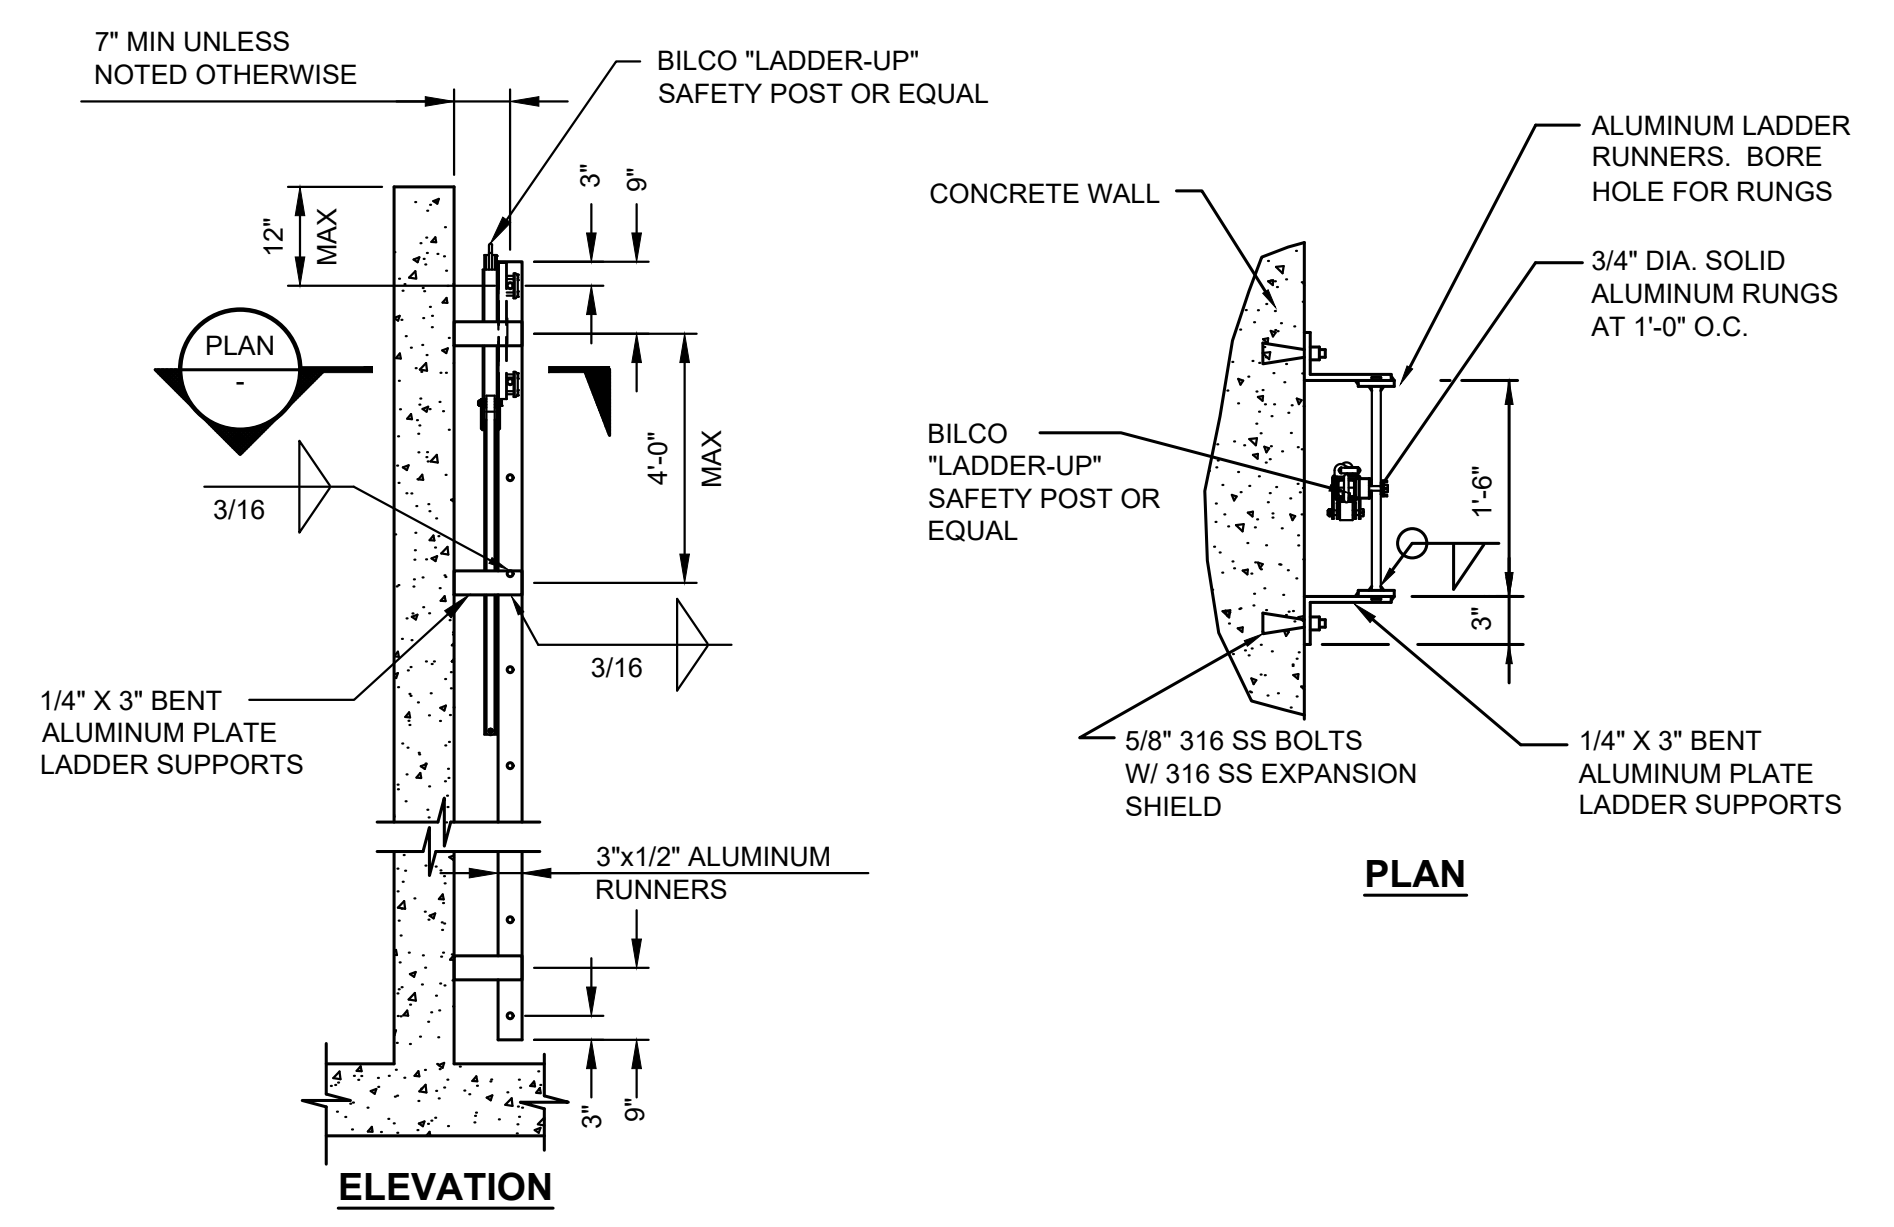

7
TYP NOT TO SCALE

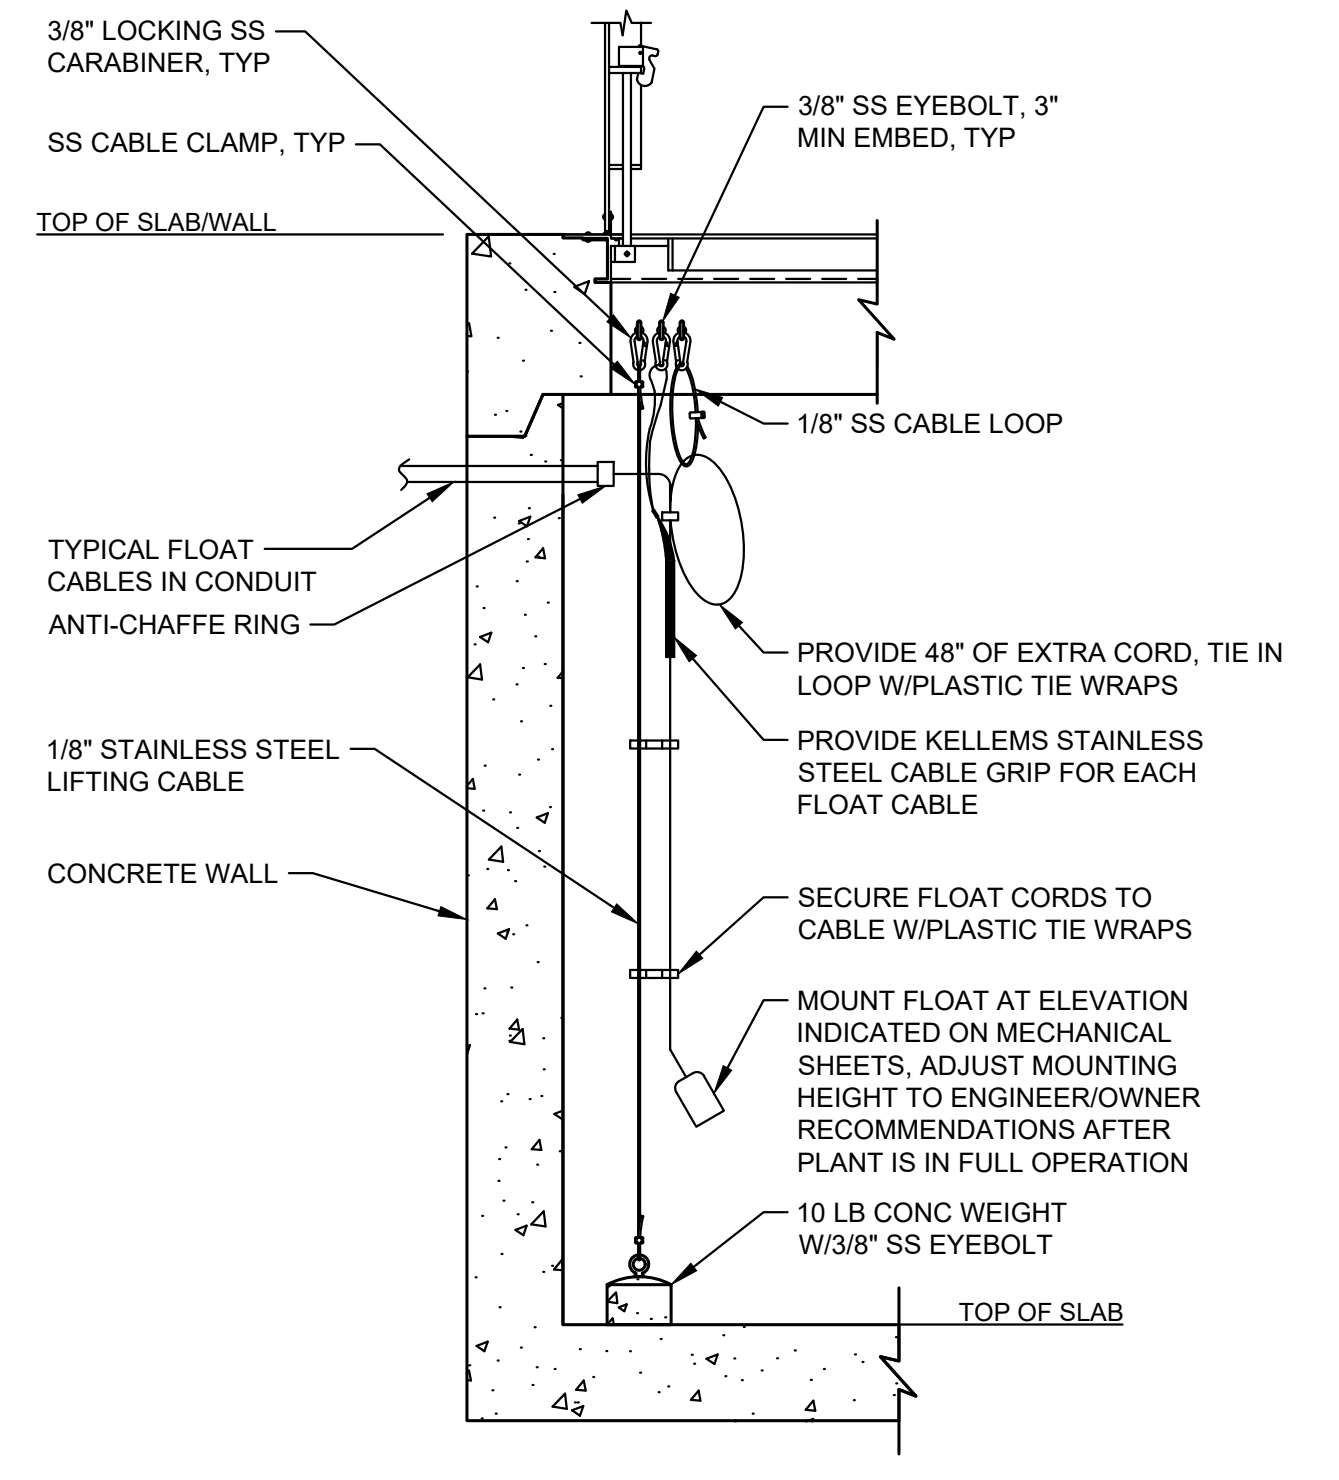



6
TYP NOT TO SCALE

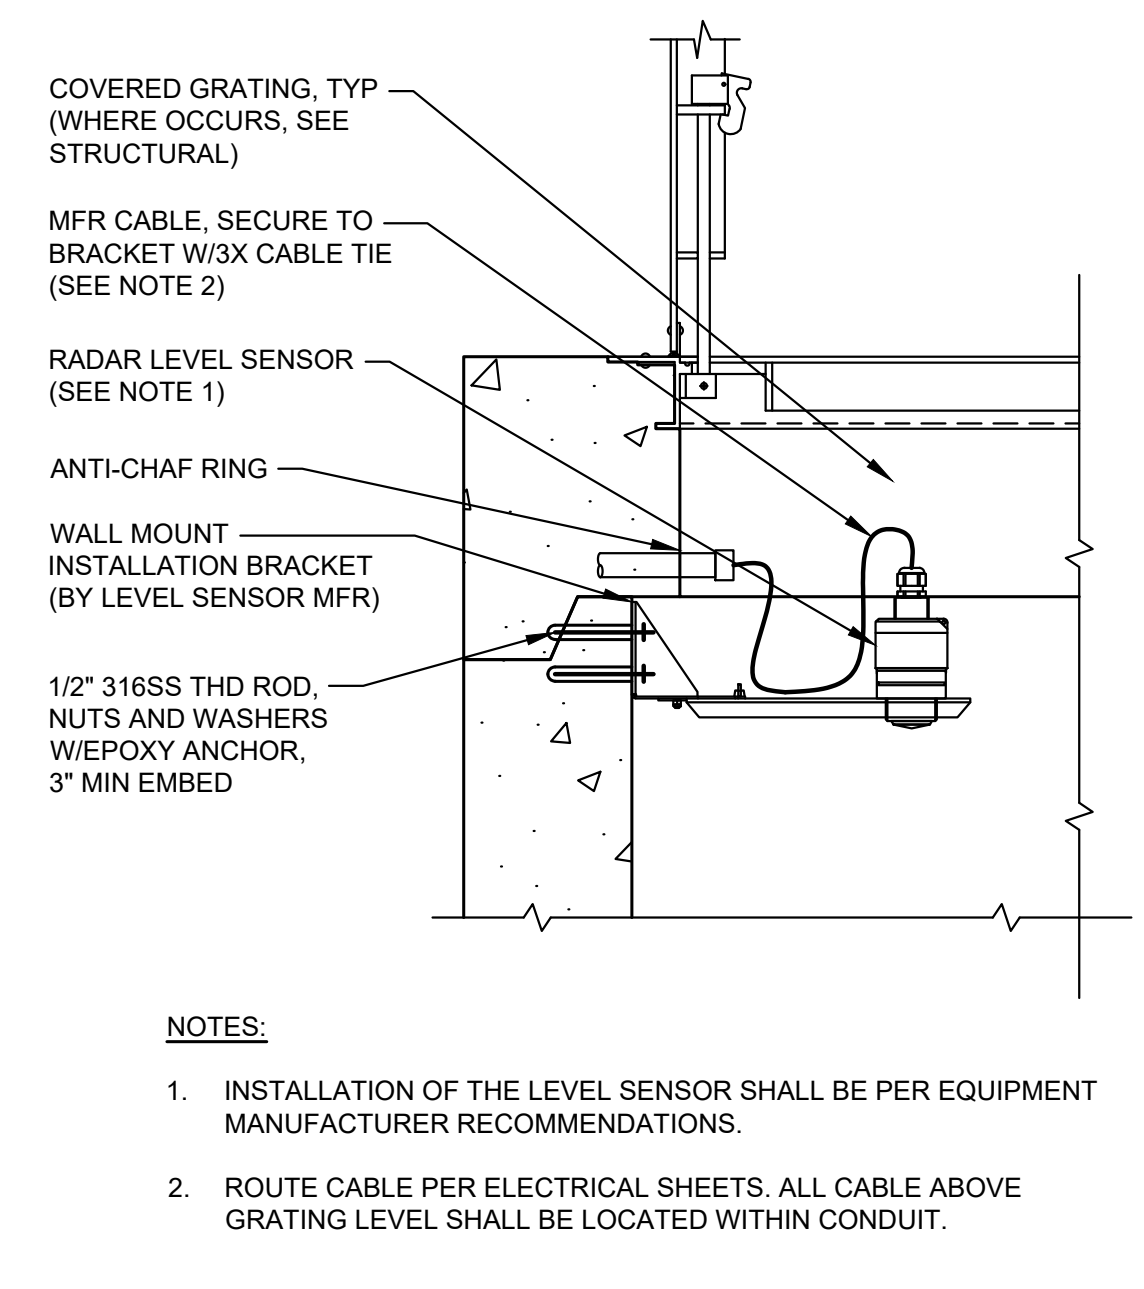

5
TYP NOT TO SCALE

- NOTES:**
- INSTALLATION OF THE LEVEL SENSOR SHALL BE PER EQUIPMENT MANUFACTURER RECOMMENDATIONS.
 - ROUTE CABLE PER ELECTRICAL SHEETS. ALL CABLE ABOVE GRATING LEVEL SHALL BE LOCATED WITHIN CONDUIT.


m:\PUYALLUP\21462 wpcp 3rd secondary clarifier\01 design\Planset\Mechanical\M_DET.dwg, 1/3/2022 1:58 PM, CHARLEY REID

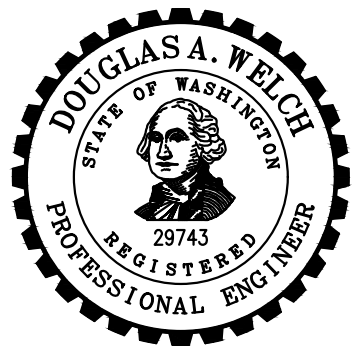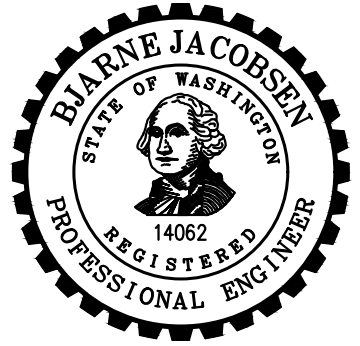

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
 1602 18TH ST NW,
 PUYALLUP, WA 98371

PRELIMINARY
NOT FOR
CONSTRUCTION



No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE:	DECEMBER 2021	
APPROVED BY:	XXX	
CHECKED BY:	XXX	
DRAWN BY:	XXX	
DESIGNER:	XXX	
G & O JOB NO.:	21462	
FILE:	M_DET.DWG	



MECHANICAL

MISCELLANEOUS
DETAILS

DRAWING: **M-4** OF: **4**

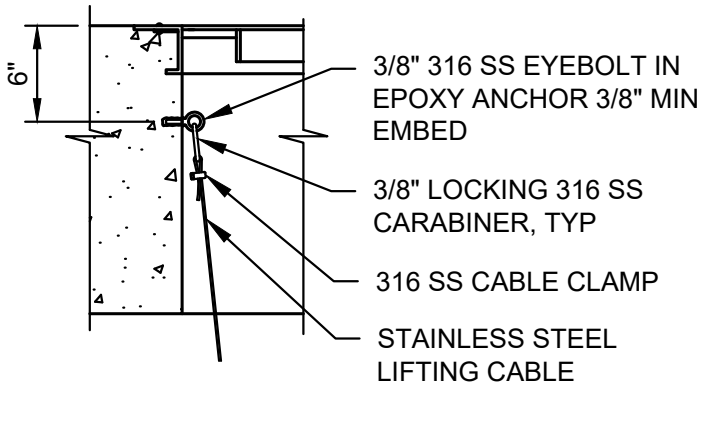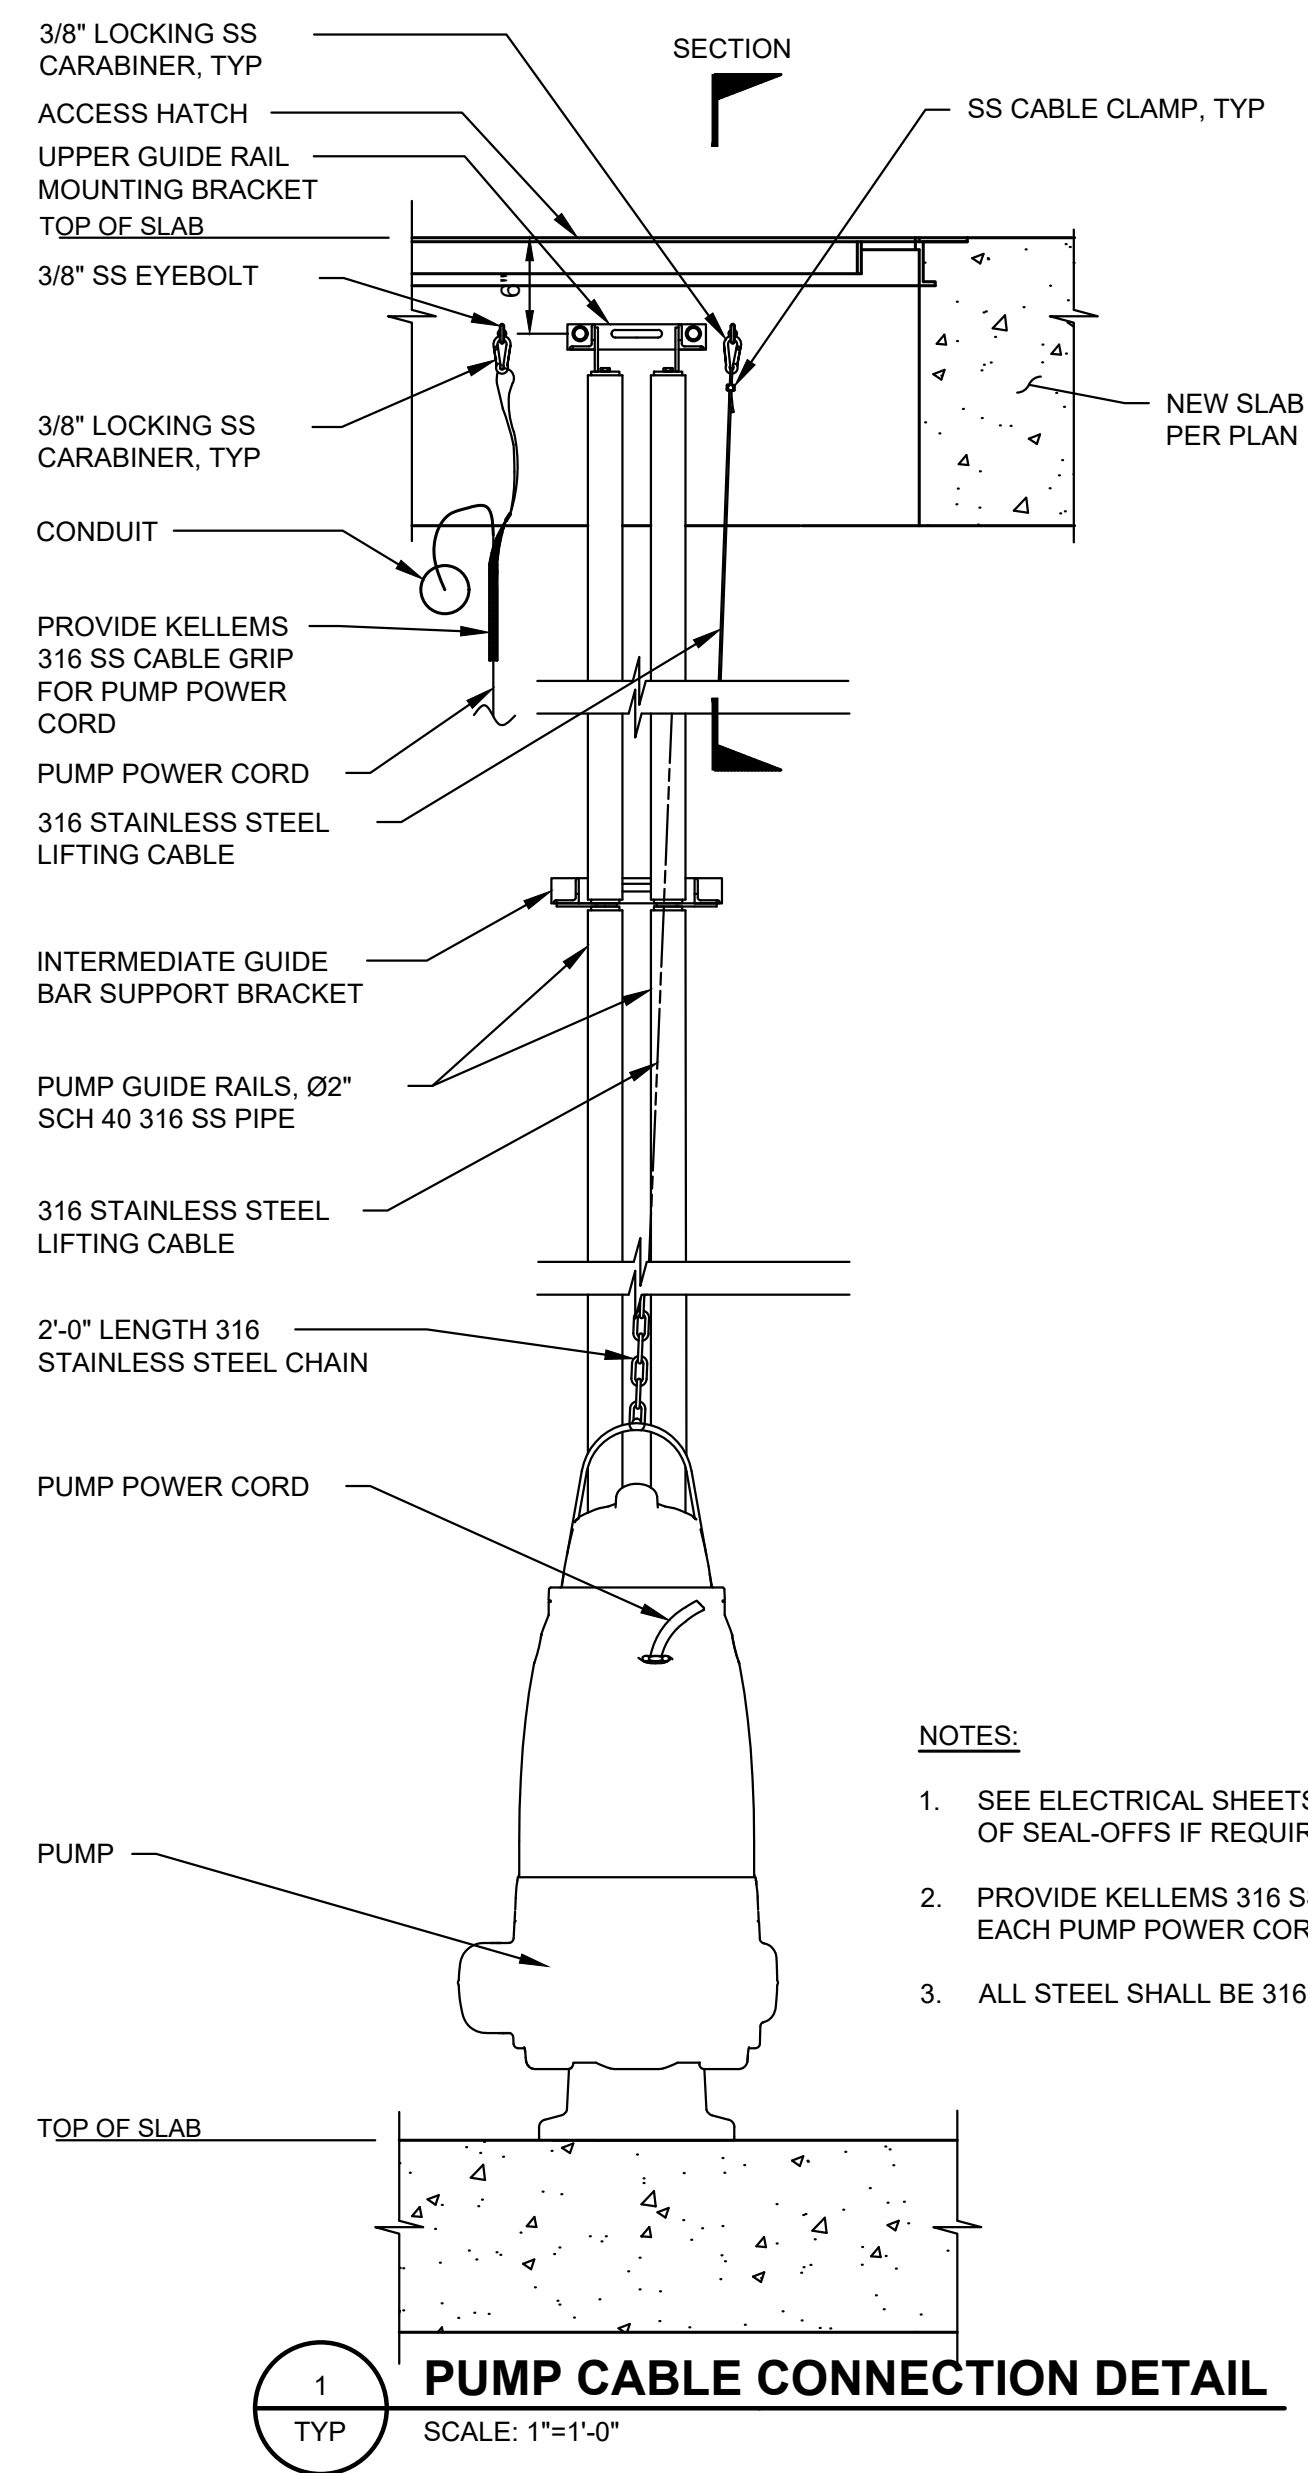


SECTION
 NOTE:
 TYPICAL FOR PUMP
 AND FLOAT CABLES

- NOTES:**
1. SEE ELECTRICAL SHEETS FOR LOCATION OF SEAL-OFFS IF REQUIRED.
 2. PROVIDE KELLEMS 316 SS CABLE GRIP FOR EACH PUMP POWER CORD.
 3. ALL STEEL SHALL BE 316 SS, UNO.

1
 TYP
PUMP CABLE CONNECTION DETAIL
 SCALE: 1"=1'-0"


APPROVED
 BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP
 APPROVED
 DATE: _____
 EXPIRATION
 DATE: _____
 NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
 The City will not be responsible for errors and/or omissions on these plans.
 Field conditions may dictate changes to these plans as determined by the City Engineer.

m:\PUYALLUP\21462\wpcp\3rd\secondary clarifier\01 design\PlanSet\Mechanical\M6_SB-PLN-SEC.dwg, 1/3/2022 1:58 PM, CHARLEY REID

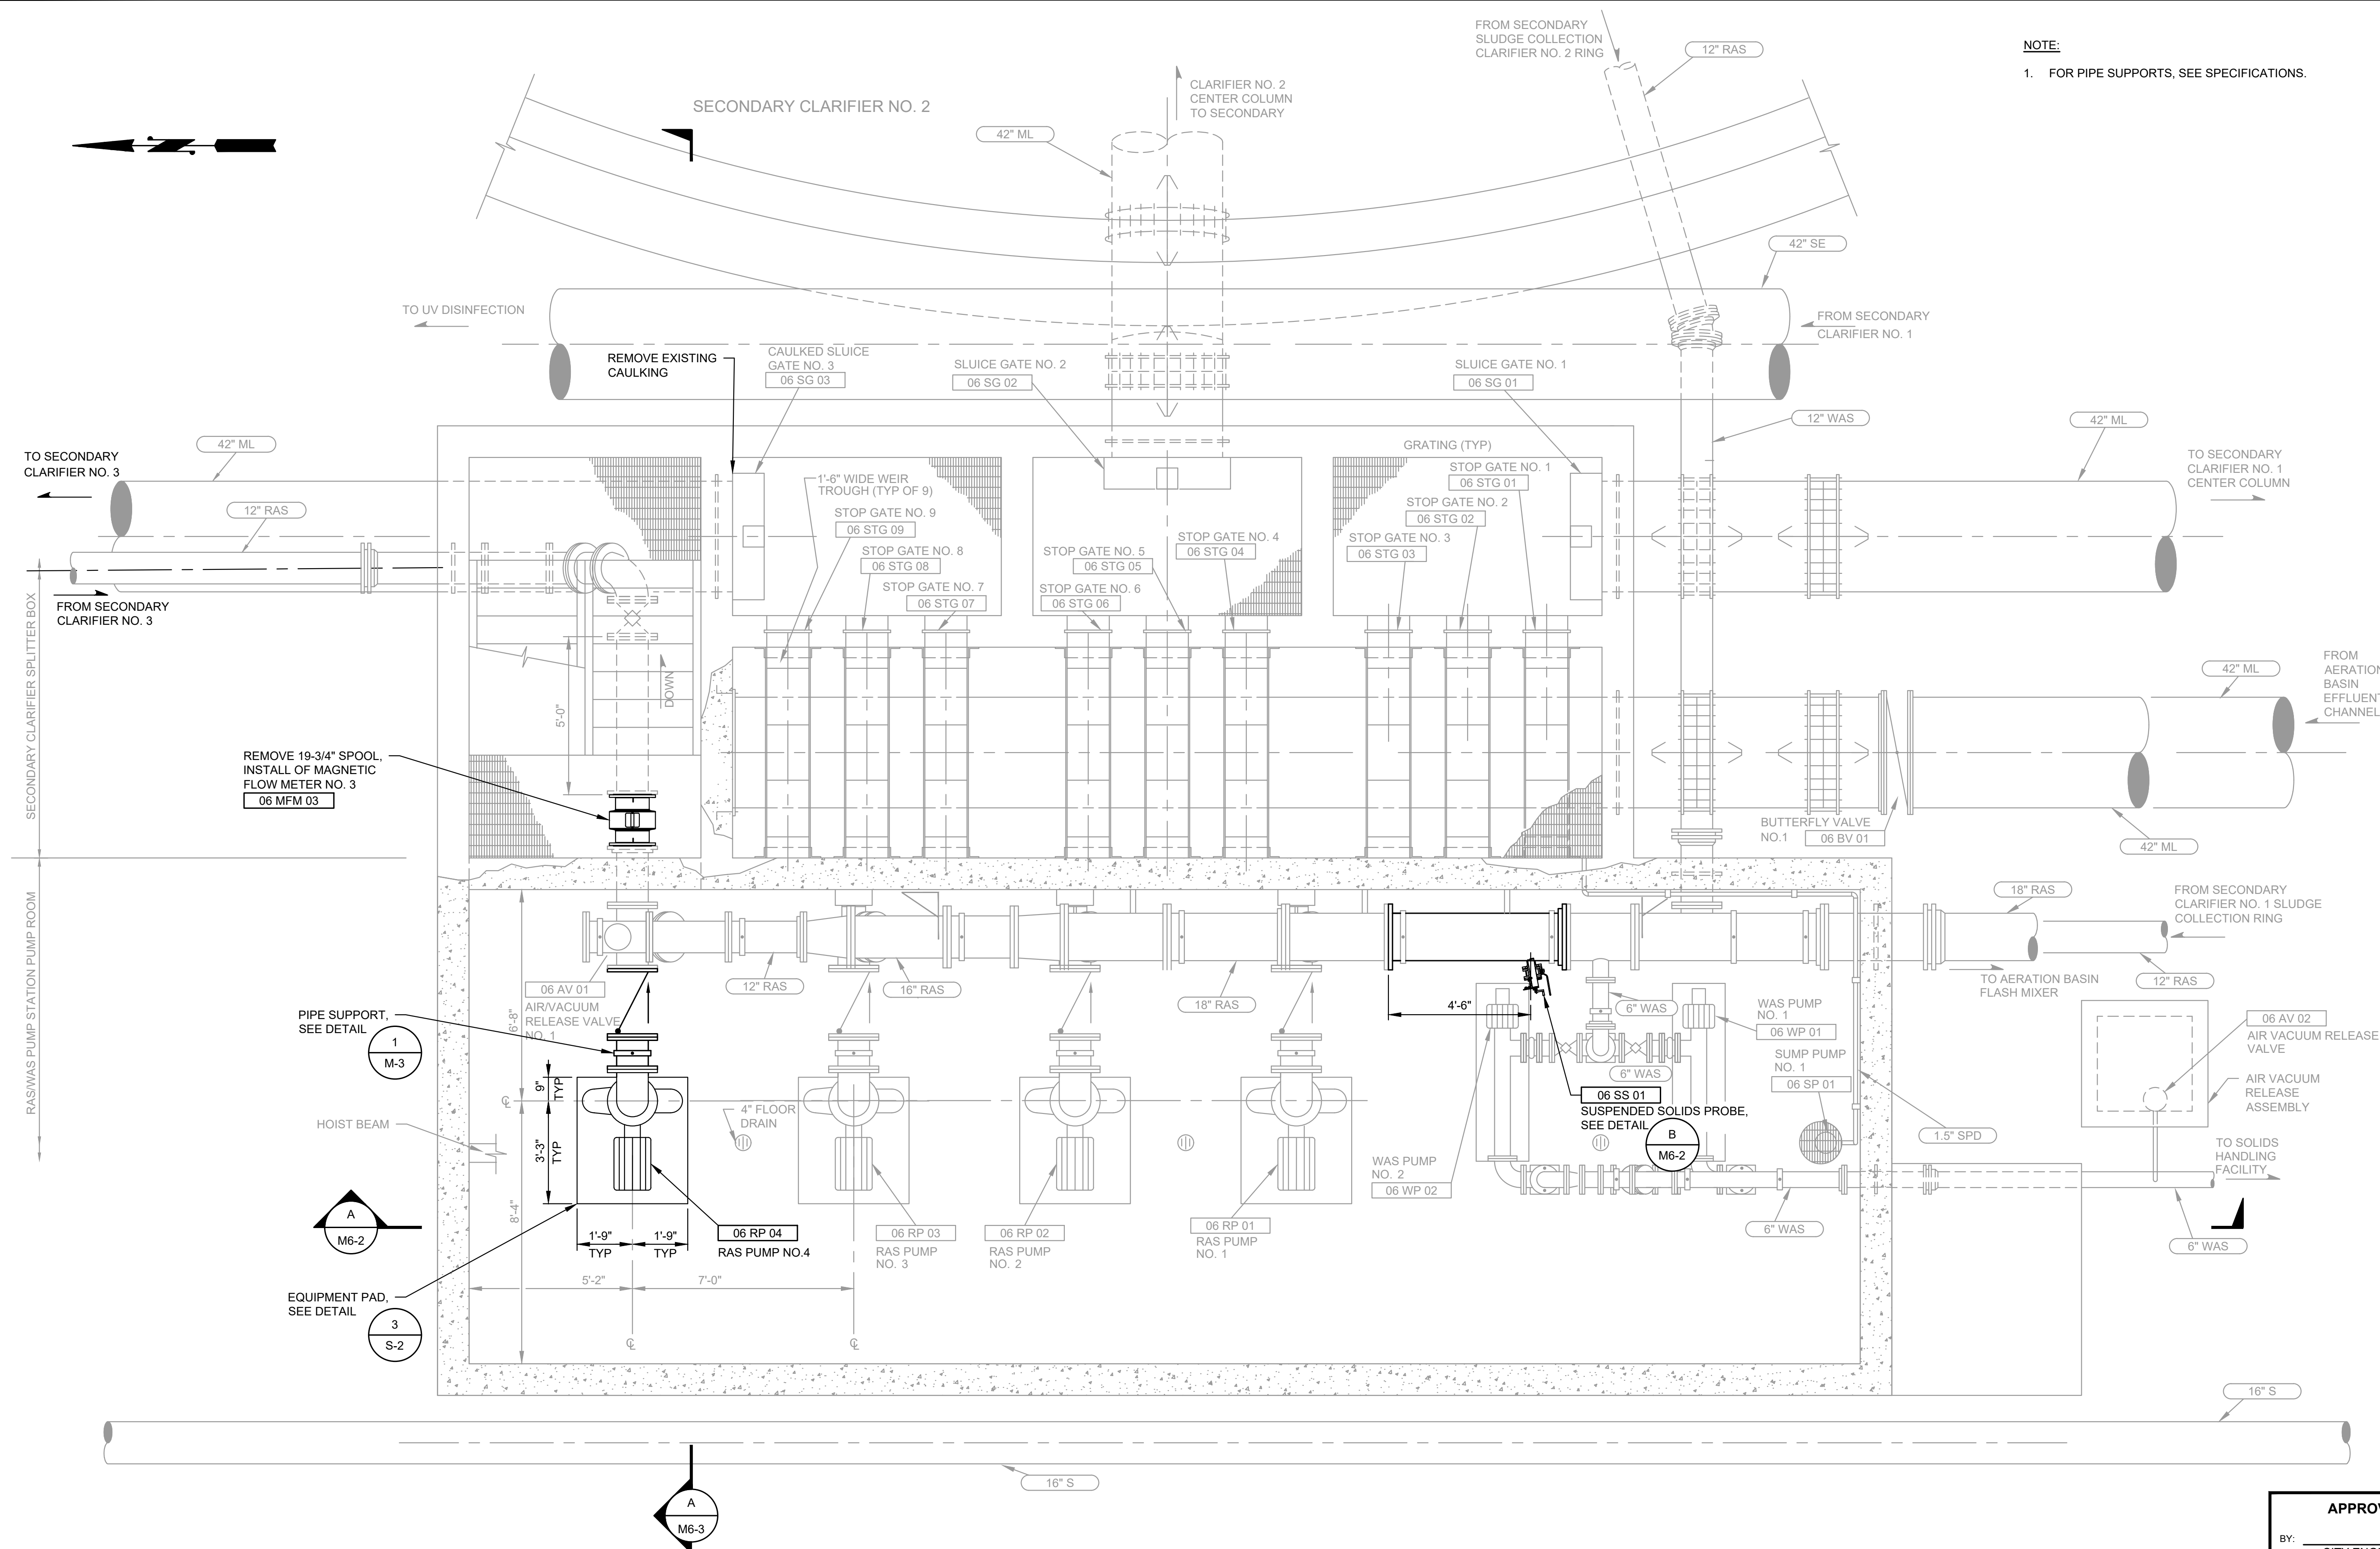

NOTE:
1. FOR PIPE SUPPORTS, SEE SPECIFICATIONS.


Gray & Osborne, Inc.
CONSULTING ENGINEERS
1130 RAINIER AVENUE SOUTH,
SUITE 300
SEATTLE, WASHINGTON 98144
(206) 284-0860

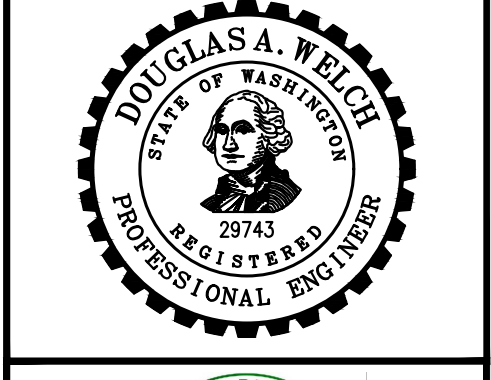

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: XXX		
CHECKED BY: XXX		
DRAWN BY: XXX		
DESIGNER: XXX		
G & O JOB NO.: 21462		
FILE: M6_SB-PLN-SEC.DWG		




**MECHANICAL
AREA 6**

SECONDARY CLARIFIER SPLITTER BOX AND RAS/WAS PUMP STATION PLAN

DRAWING: **M6-1** OF: **3**

**SECONDARY CLARIFIER SPLITTER BOX
AND RAS/WAS PUMP STATION PLAN**
SCALE: 3/8"=1'-0"


APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

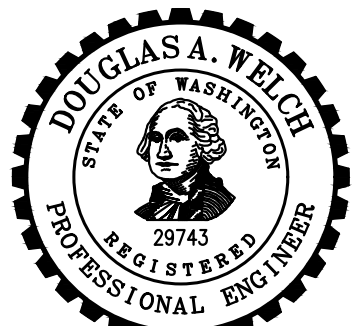

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
 1602 18TH ST NW,
 PUYALLUP, WA 98371

PRELIMINARY
NOT FOR
CONSTRUCTION


No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: XXX		
CHECKED BY: XXX		
DRAWN BY: XXX		
DESIGNER: XXX		
G & O JOB NO.: 21462		
FILE: M6_SB-PLN-SEC.DWG		



MECHANICAL
AREA 6
SECONDARY
CLARIFIER SPLITTER
BOX AND RAS/WAS
PUMP STATION
SECTIONS


DRAWING: **M6-2** OF: **3**

APPROVED
 BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP
 APPROVED
 DATE: _____
 EXPIRATION
 DATE: _____
 NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
 The City will not be responsible for errors and/or omissions on these plans.
 Field conditions may dictate changes to these plans as determined by the City Engineer.

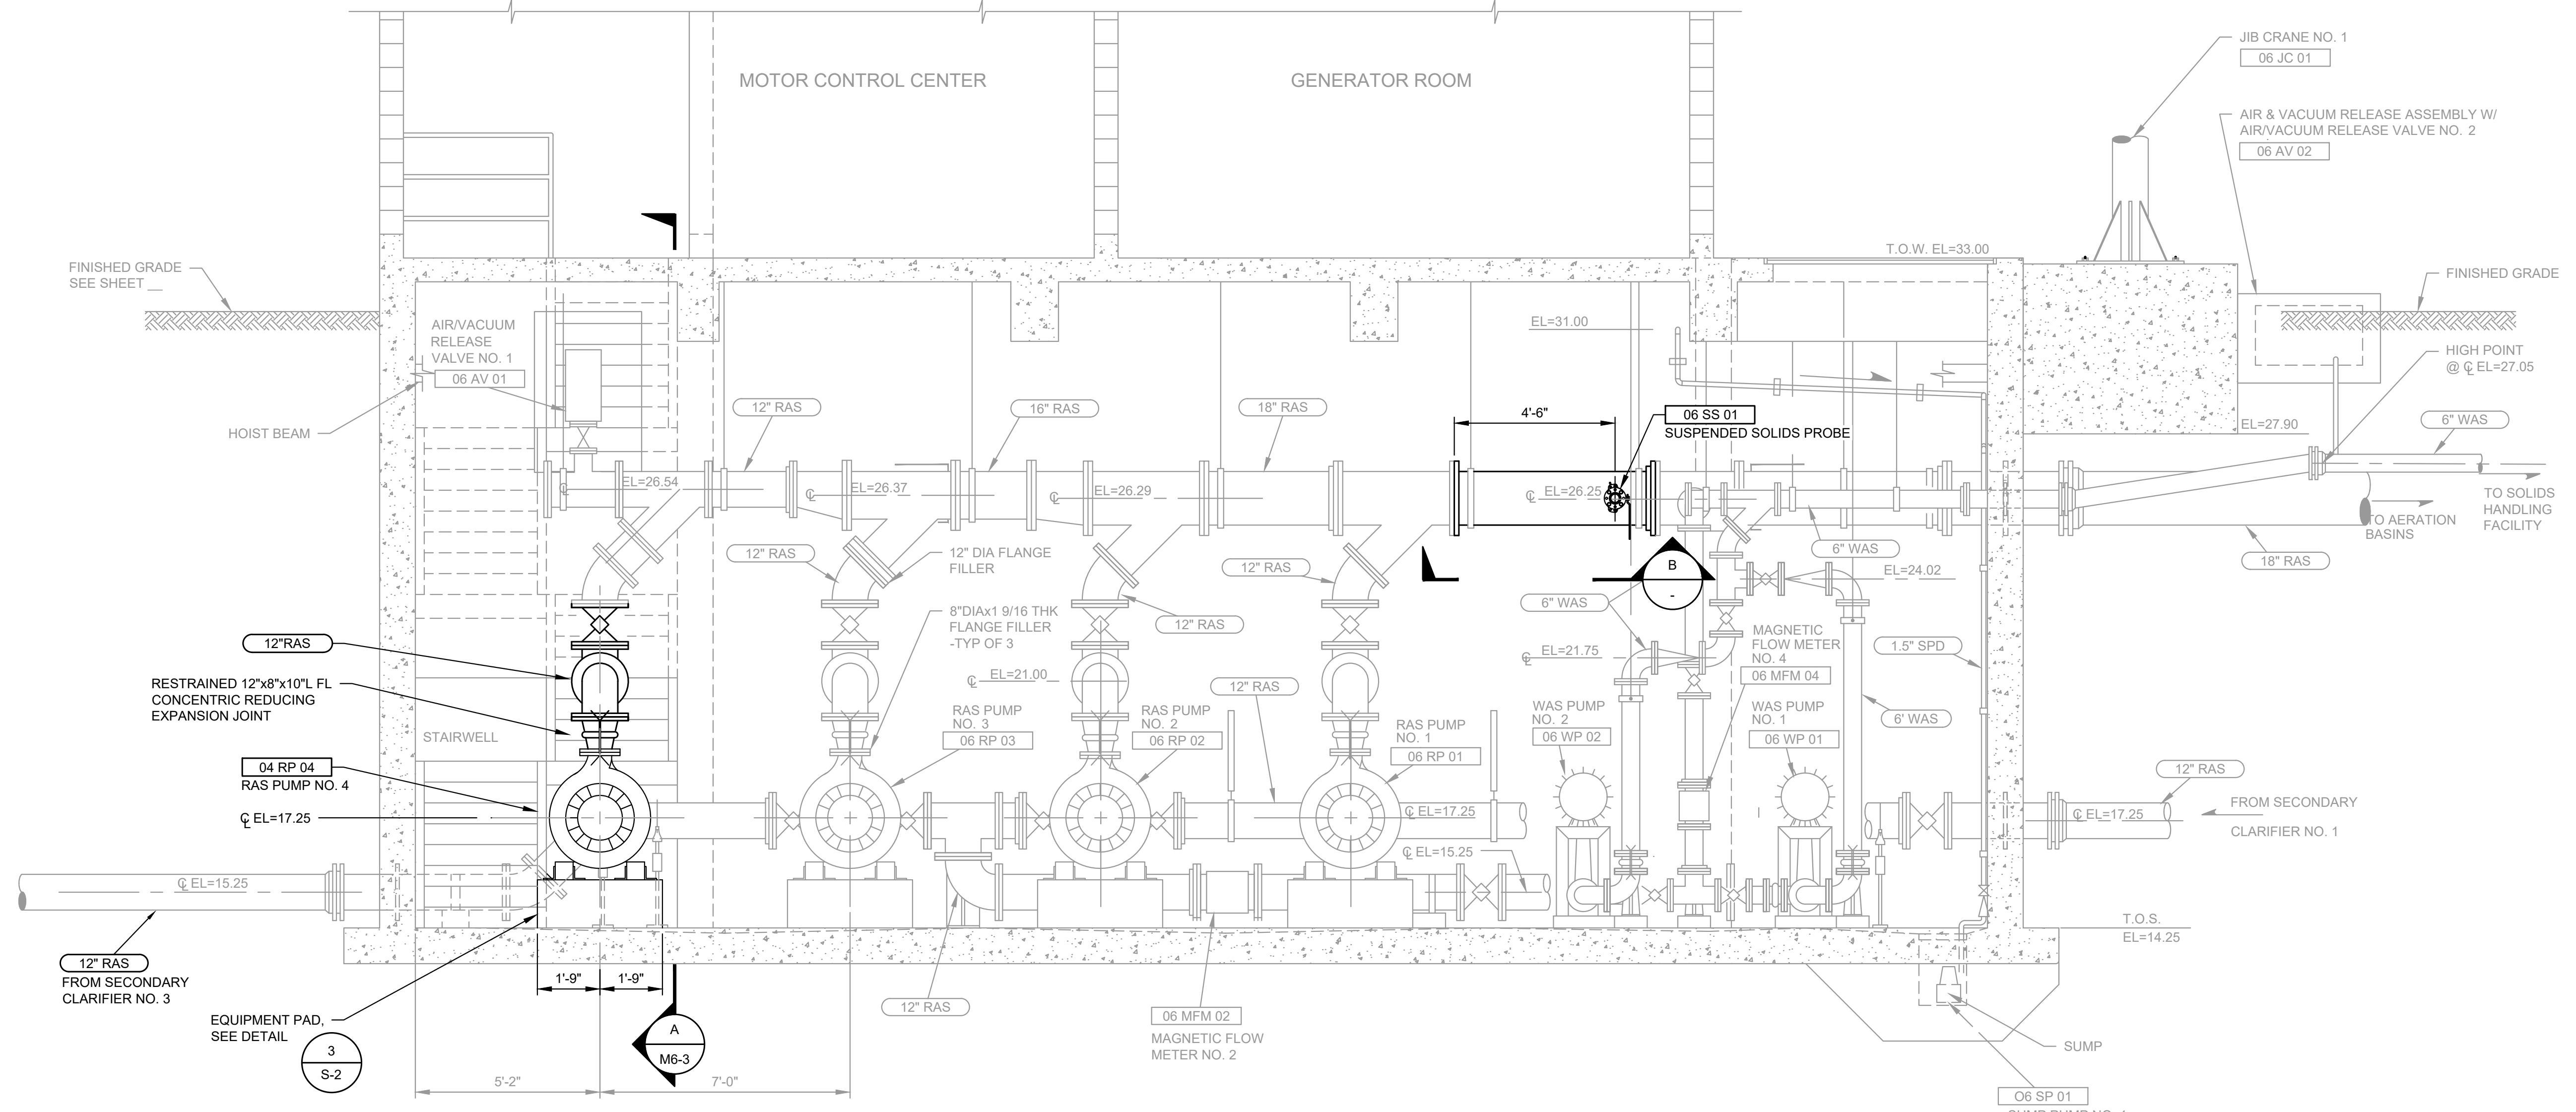



A SECTION
 M6-1 SCALE: 3/8"=1'-0"

NOTE:
 1. FOR PIPE SUPPORTS, SEE SPECIFICATIONS.

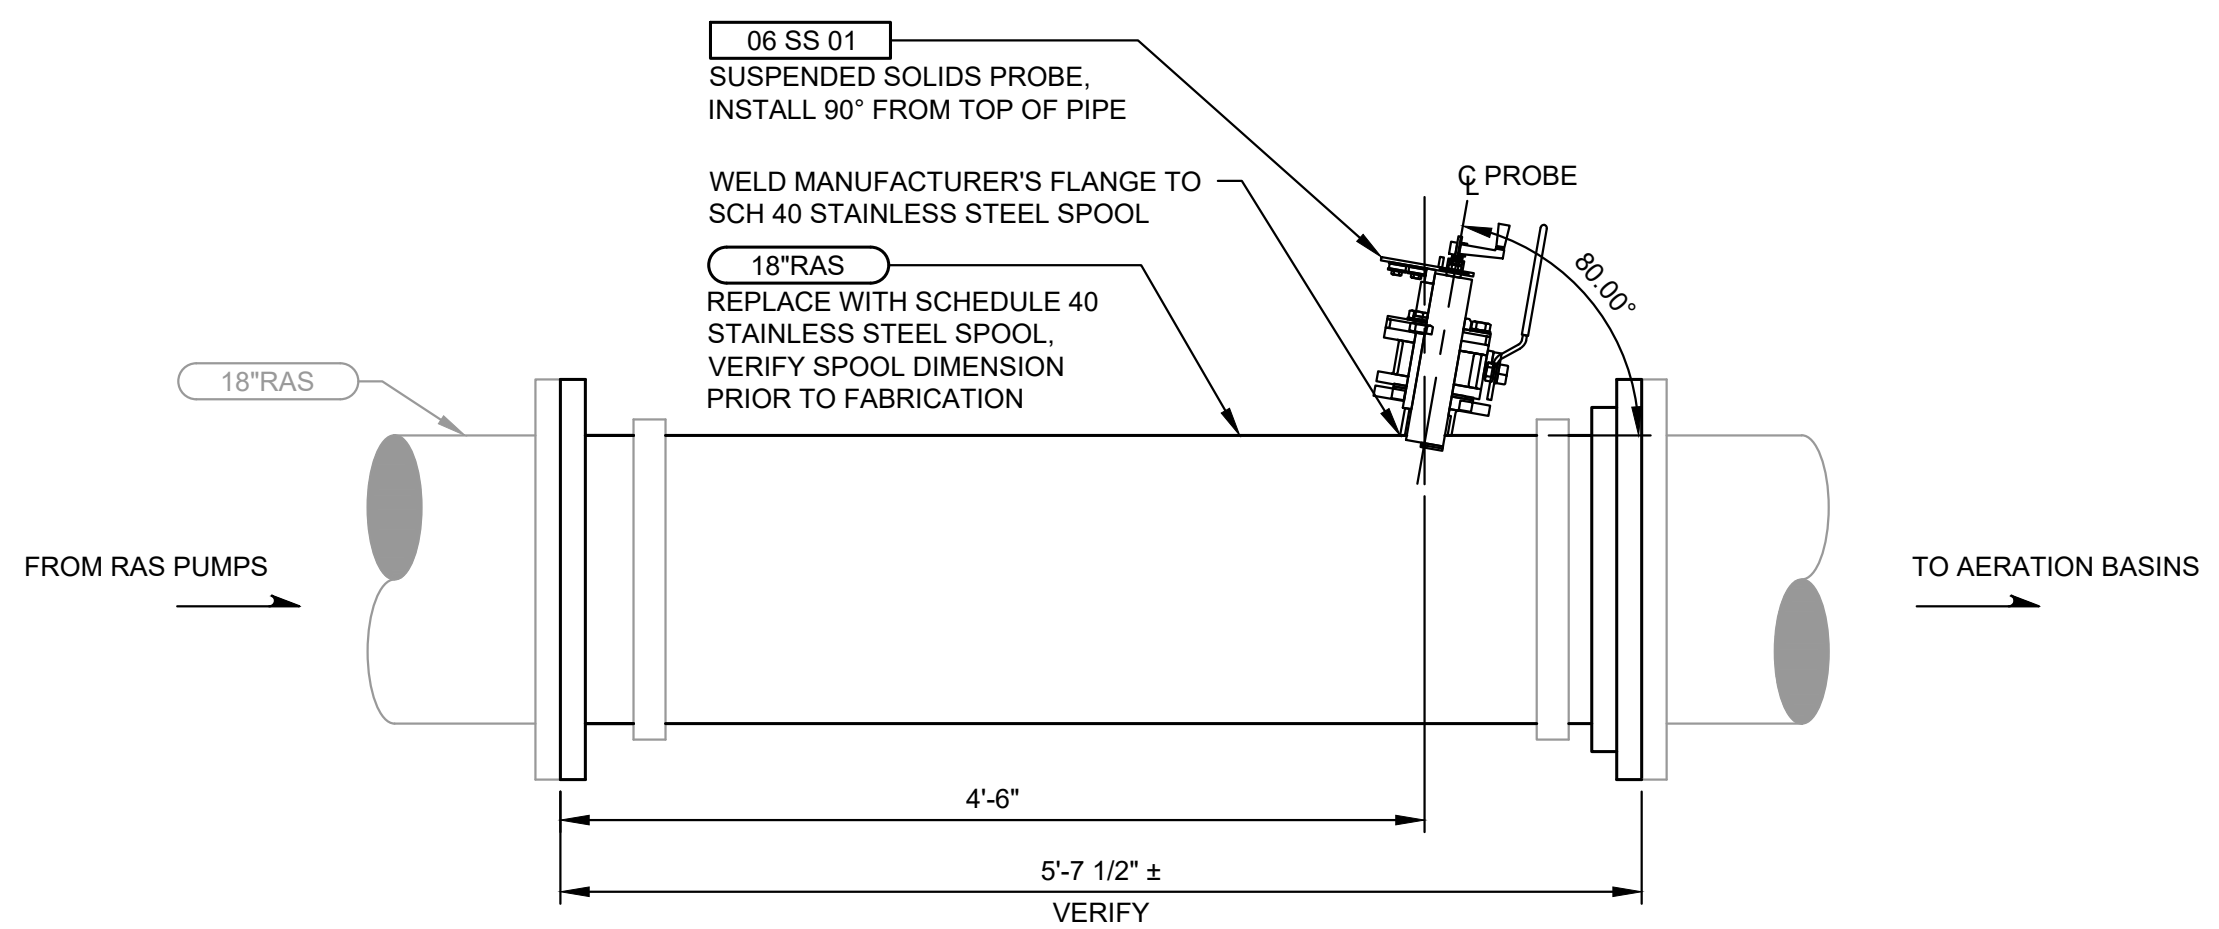

B SECTION
 SCALE: 3/8"=1'-0"


m:\PUYALLUP\21462\wpcp\3rd\secondary clarifier\01 design\PlanSet\Mechanical\M6_SB-PLN-SEC.dwg, 1/3/2022, 1:58 PM, CHARLEY REID

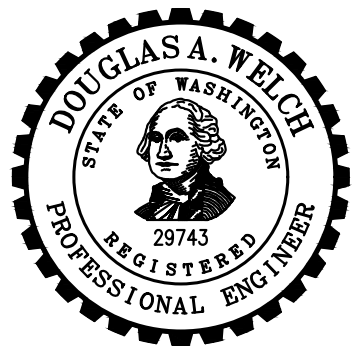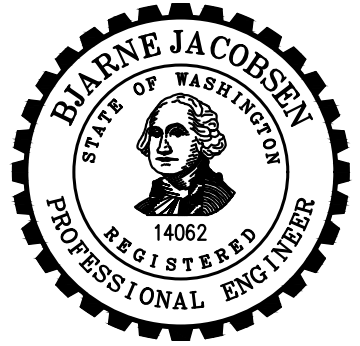

CITY OF PUYALLUP
 WATER POLLUTION
 CONTROL PLANT THIRD
 SECONDARY CLARIFIER
 CIP NO. 20-018
 1602 18TH ST NW,
 PUYALLUP, WA 98371

**PRELIMINARY
 NOT FOR
 CONSTRUCTION**


No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: XXX		
CHECKED BY: XXX		
DRAWN BY: XXX		
DESIGNER: XXX		
G & O JOB NO.: 21462		
FILE: M6_SB-PLN-SEC.DWG		



MECHANICAL
AREA 6
SECONDARY CLARIFIER SPLITTER BOX AND RAS/WAS PUMP STATION SECTIONS AND DETAILS

DRAWING: **M6-3** OF: **3**

APPROVED
 BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP
 APPROVED
 DATE: _____
 EXPIRATION
 DATE: _____
 NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
 The City will not be responsible for errors and/or omissions on these plans.
 Field conditions may dictate changes to these plans as determined by the City Engineer.

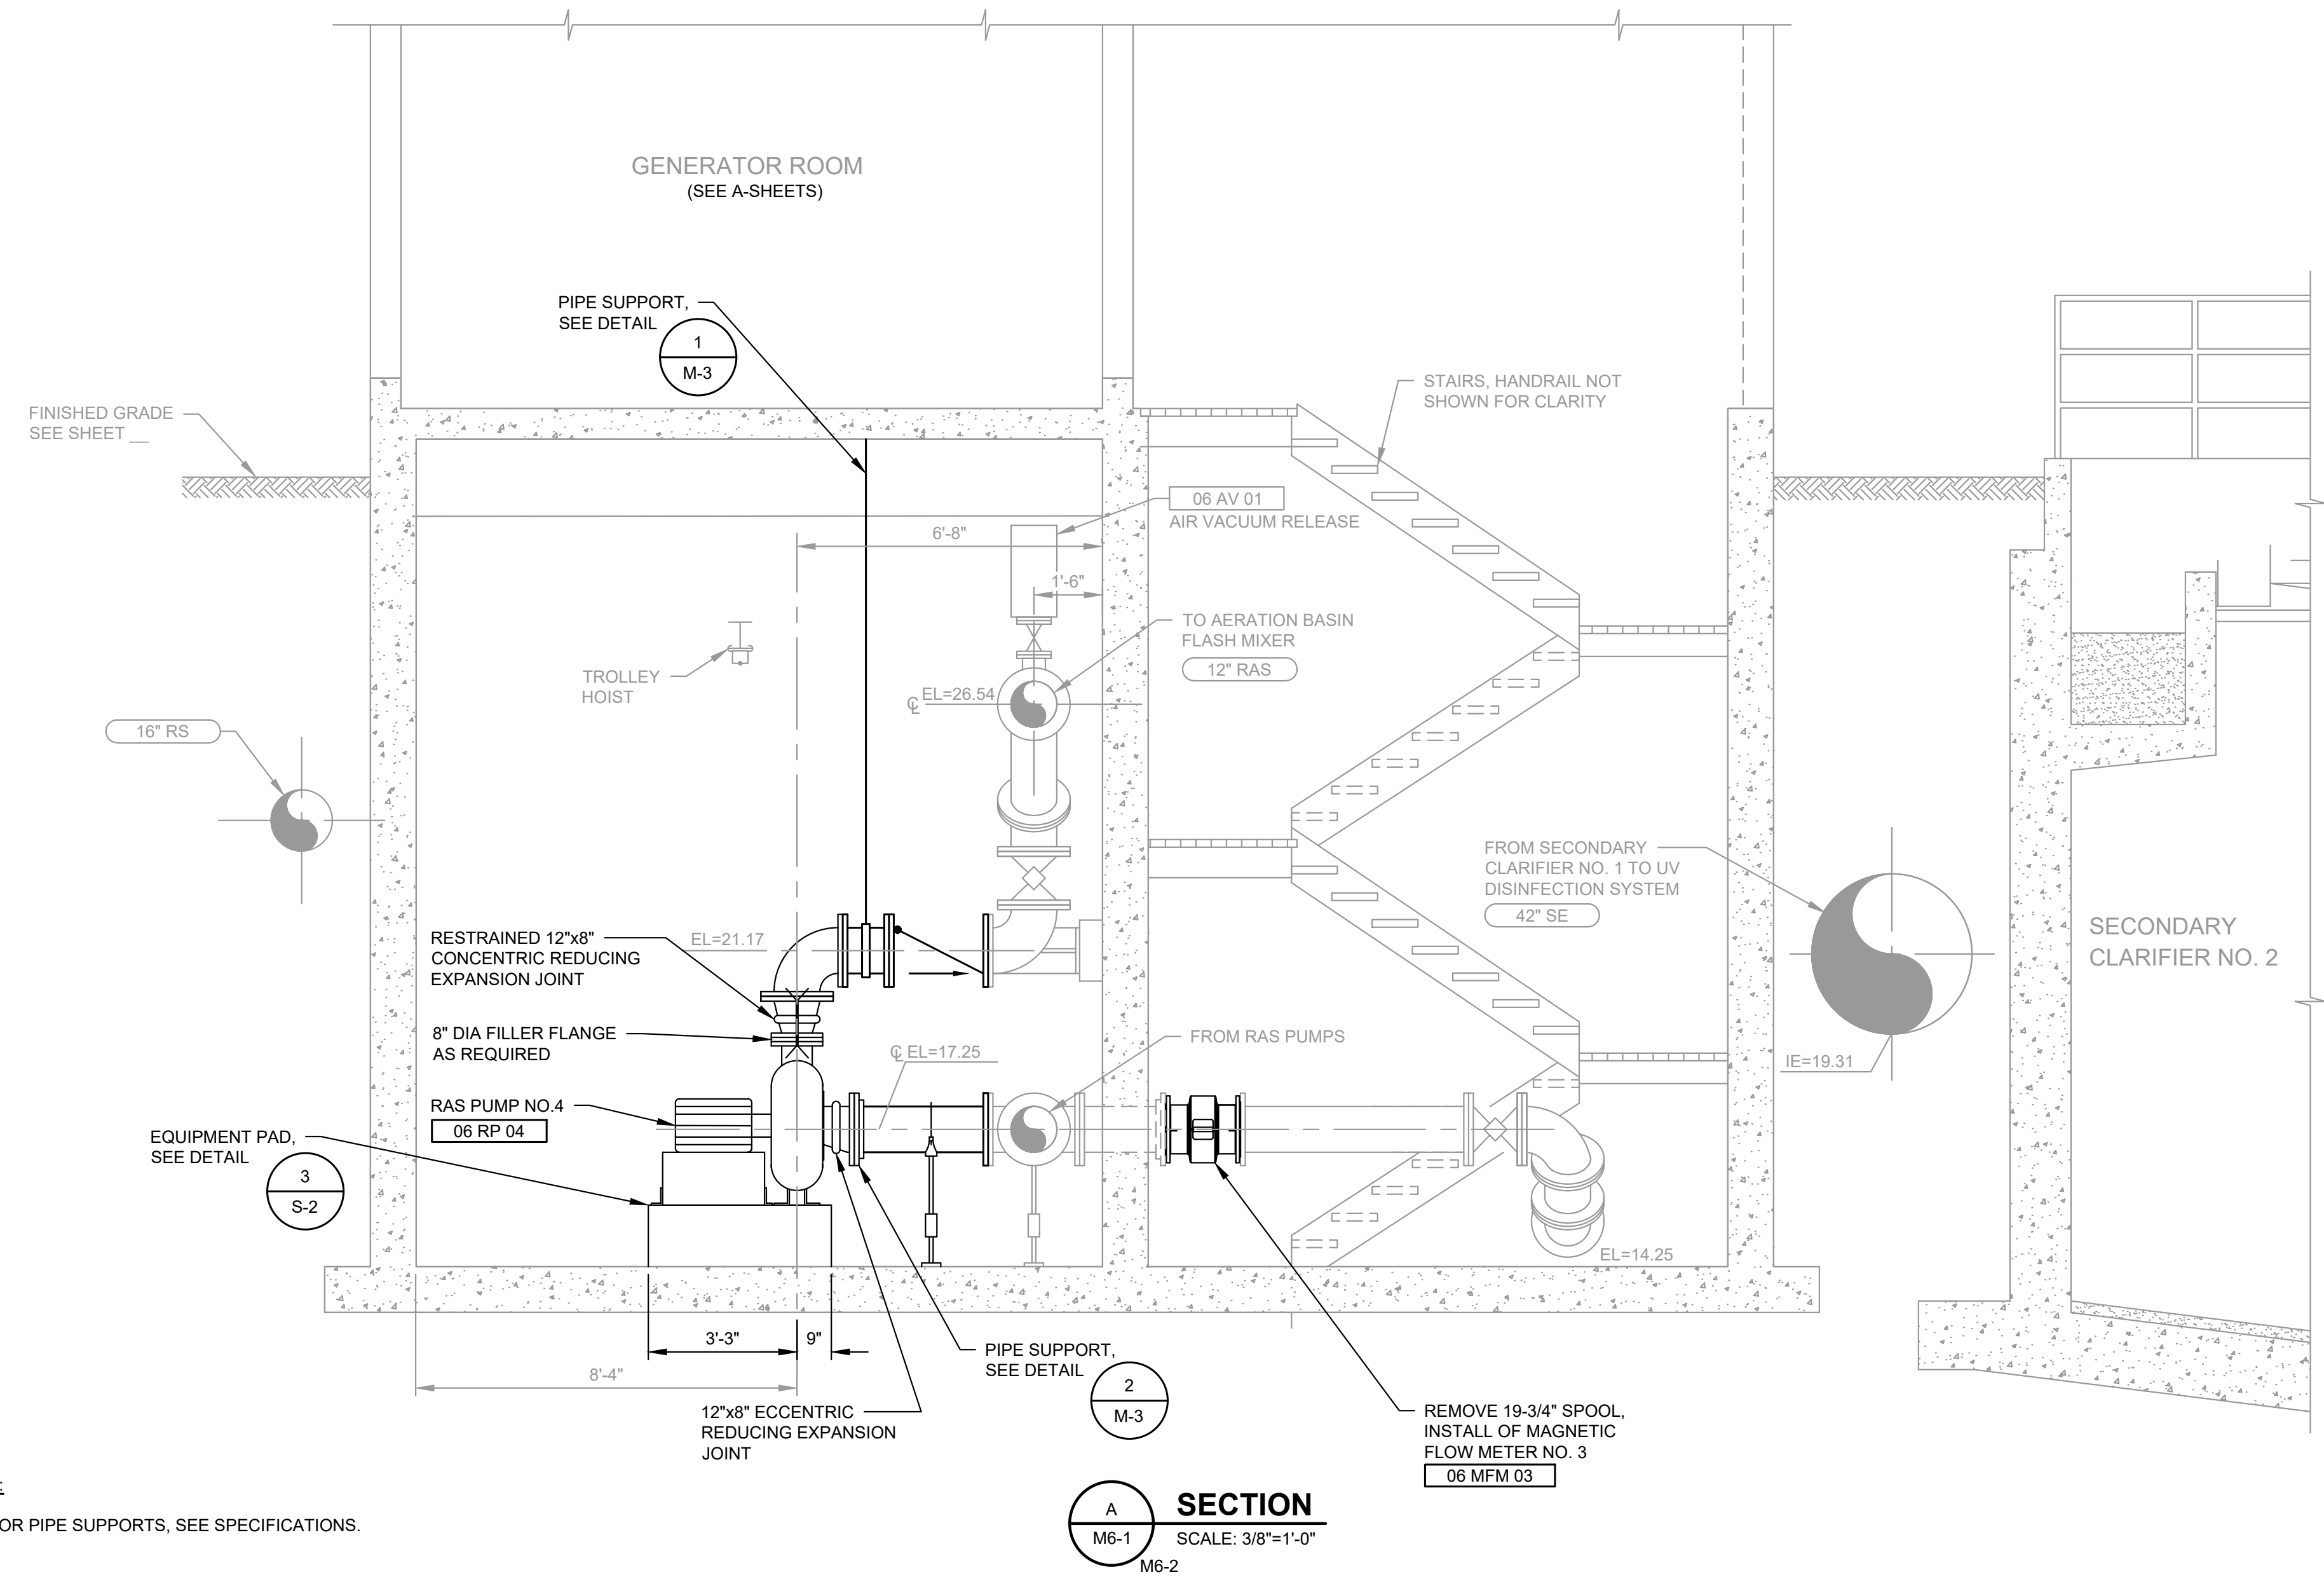

NOTE:
 1. FOR PIPE SUPPORTS, SEE SPECIFICATIONS.

SECTION
 A
 M6-1 M6-2
 SCALE: 3/8"=1'-0"


m:\PUYALLUP\21462\wpcp\3rd_secondary clarifier\01_design\PlanSet\Mechanical\M6_SB-PLN-SEC.dwg, 1/3/2022 1:59 PM, CHARLEY REID

m:\PUYALLUP\21462\wpcp\3rd_secondary clarifier01 design\Planset\Mechanical\M7_SC3-PLN.dwg, 1/3/2022 1:59 PM, CHARLEY REID

NOTES:

- FOR PIPING PENETRATIONS, SEE DETAIL M-2
- FOR RESTRAINED FLEXIBLE COUPLINGS, SEE DETAIL M-2
- SECONDARY CLARIFIER SHALL HAVE ALGAE SWEEP SYSTEM INSTALLED AT END OF MECHANISM TO CLEAN EFFLUENT CHANNEL AND EFFLUENT WEIR.
- FOR SECTIONAL ELEVATION OF CLARIFIERS SEE SECTION A/M7-2
- ATTACH INTERFACE LEVEL ANALYZER TO HANDRAIL AND INSTALL IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. INTERFACE LEVEL ANALYZER 07 ILA 03 FOR SECONDARY CLARIFIER NO. 3 IS SHOWN. INSTALL NEW INTERFACE LEVEL ANALYZERS 07 ILA 01 AND 07 ILA 02 AT IDENTICAL LOCATIONS ALONG WALKWAYS FOR EXISTING CLARIFIER NO. 1 AND CLARIFIER NO. 2 RESPECTIVELY.

SECONDARY CLARIFIER NO. 3

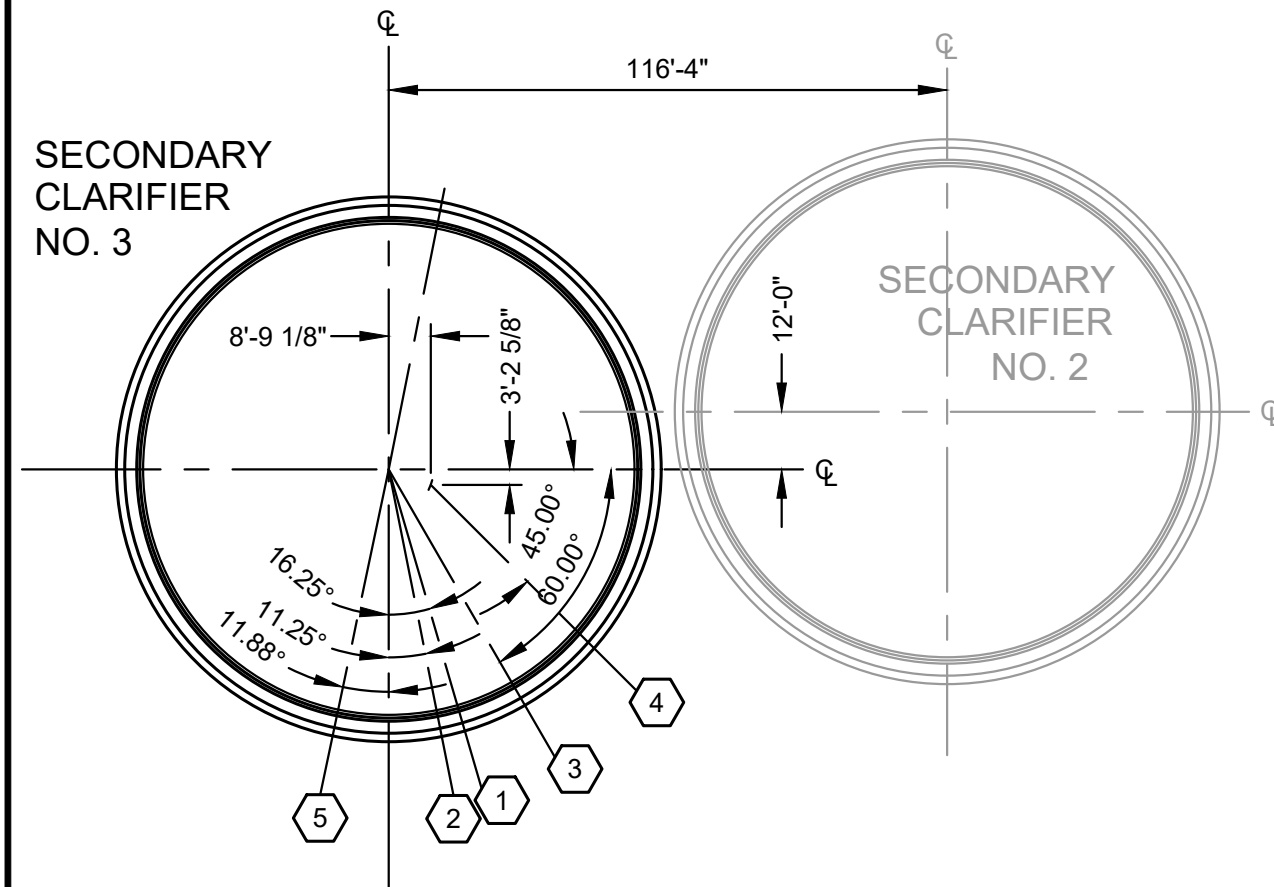

LEGEND FOR SECONDARY CLARIFIER ORIENTATION PLAN

- 1 6" SCUM BOX & 6" SC PIPE
- 2 6" WALKWAY BRIDGE
- 3 42" ML INFLUENT PIPE
- 4 12" RAS WITHDRAWAL PIPE
- 5 36" SE EFFLUENT DROP & 36" SE PIPE

SECONDARY CLARIFIERS ORIENTATION PLAN

SCALE: 1"=48'-0"

FIBERGLASS WEIR/EFFLUENT BAFFLE/STAMFORD BAFFLE

- 1 1/4"x12" FIBERGLASS SCUM BAFFLE PLATE
- 2 1/4"x10" V-NOTCH FIBERGLASS WEIR PLATE WITH NEOPRENE SEAL, SEE DETAIL M7-2
- 3 L 6x6x3/8x3" AND L 6x6x3/8x3" 316 SS BAFFLE SUPPORT BRACKETS @ 4'-0" OC AT WALL
- 4 (2) 3/8"x1 3/4" FLAT HEAD BOLTS w/WASHERS AND NUTS. PROVIDE 7/16"x1 1/2" SLOTTED HOLE IN L 6x6x3/8
- 5 3/4"x2" BOLT w/WASHER AND NUT. PROVIDE 13/16"x1 3/4" SLOTTED HOLE IN L 6x6x3/8
- 6 (2) 1/2"x6" SS THREADED ROD, EMBED 4" IN EPOXY ANCHOR w/WASHER AND NUT. PROVIDE 9/16"x1 1/2" SLOTTED HOLE IN L 6x6x3/8. FOR HOLE IN WEIR PLATE, SEE DETAIL M7-2
- 7 1/4" FIBERGLASS STAMFORD BAFFLE
- 8 6" SS THREADED ROD, EMBED 4" IN EPOXY ANCHOR w/WASHER AND NUT, 24" OC, TYP

GROUT FILL IN EFFLUENT LAUNDER


- 1 HIGH POINT @ 180° FROM EFFLUENT PIPE
- 2 135° FROM EFFLUENT PIPE
- 3 90° FROM EFFLUENT PIPE
- 4 45° FROM EFFLUENT PIPE
- 5 LOW POINT @ EFFLUENT PIPE, SEE SECTION C/M7-2

NOTE:

- ALL NUTS, BOLTS, AND WASHERS SHALL BE 316 SS.

EFFLUENT LAUNDER SECTION


SCALE: 1/2"=1'-0"

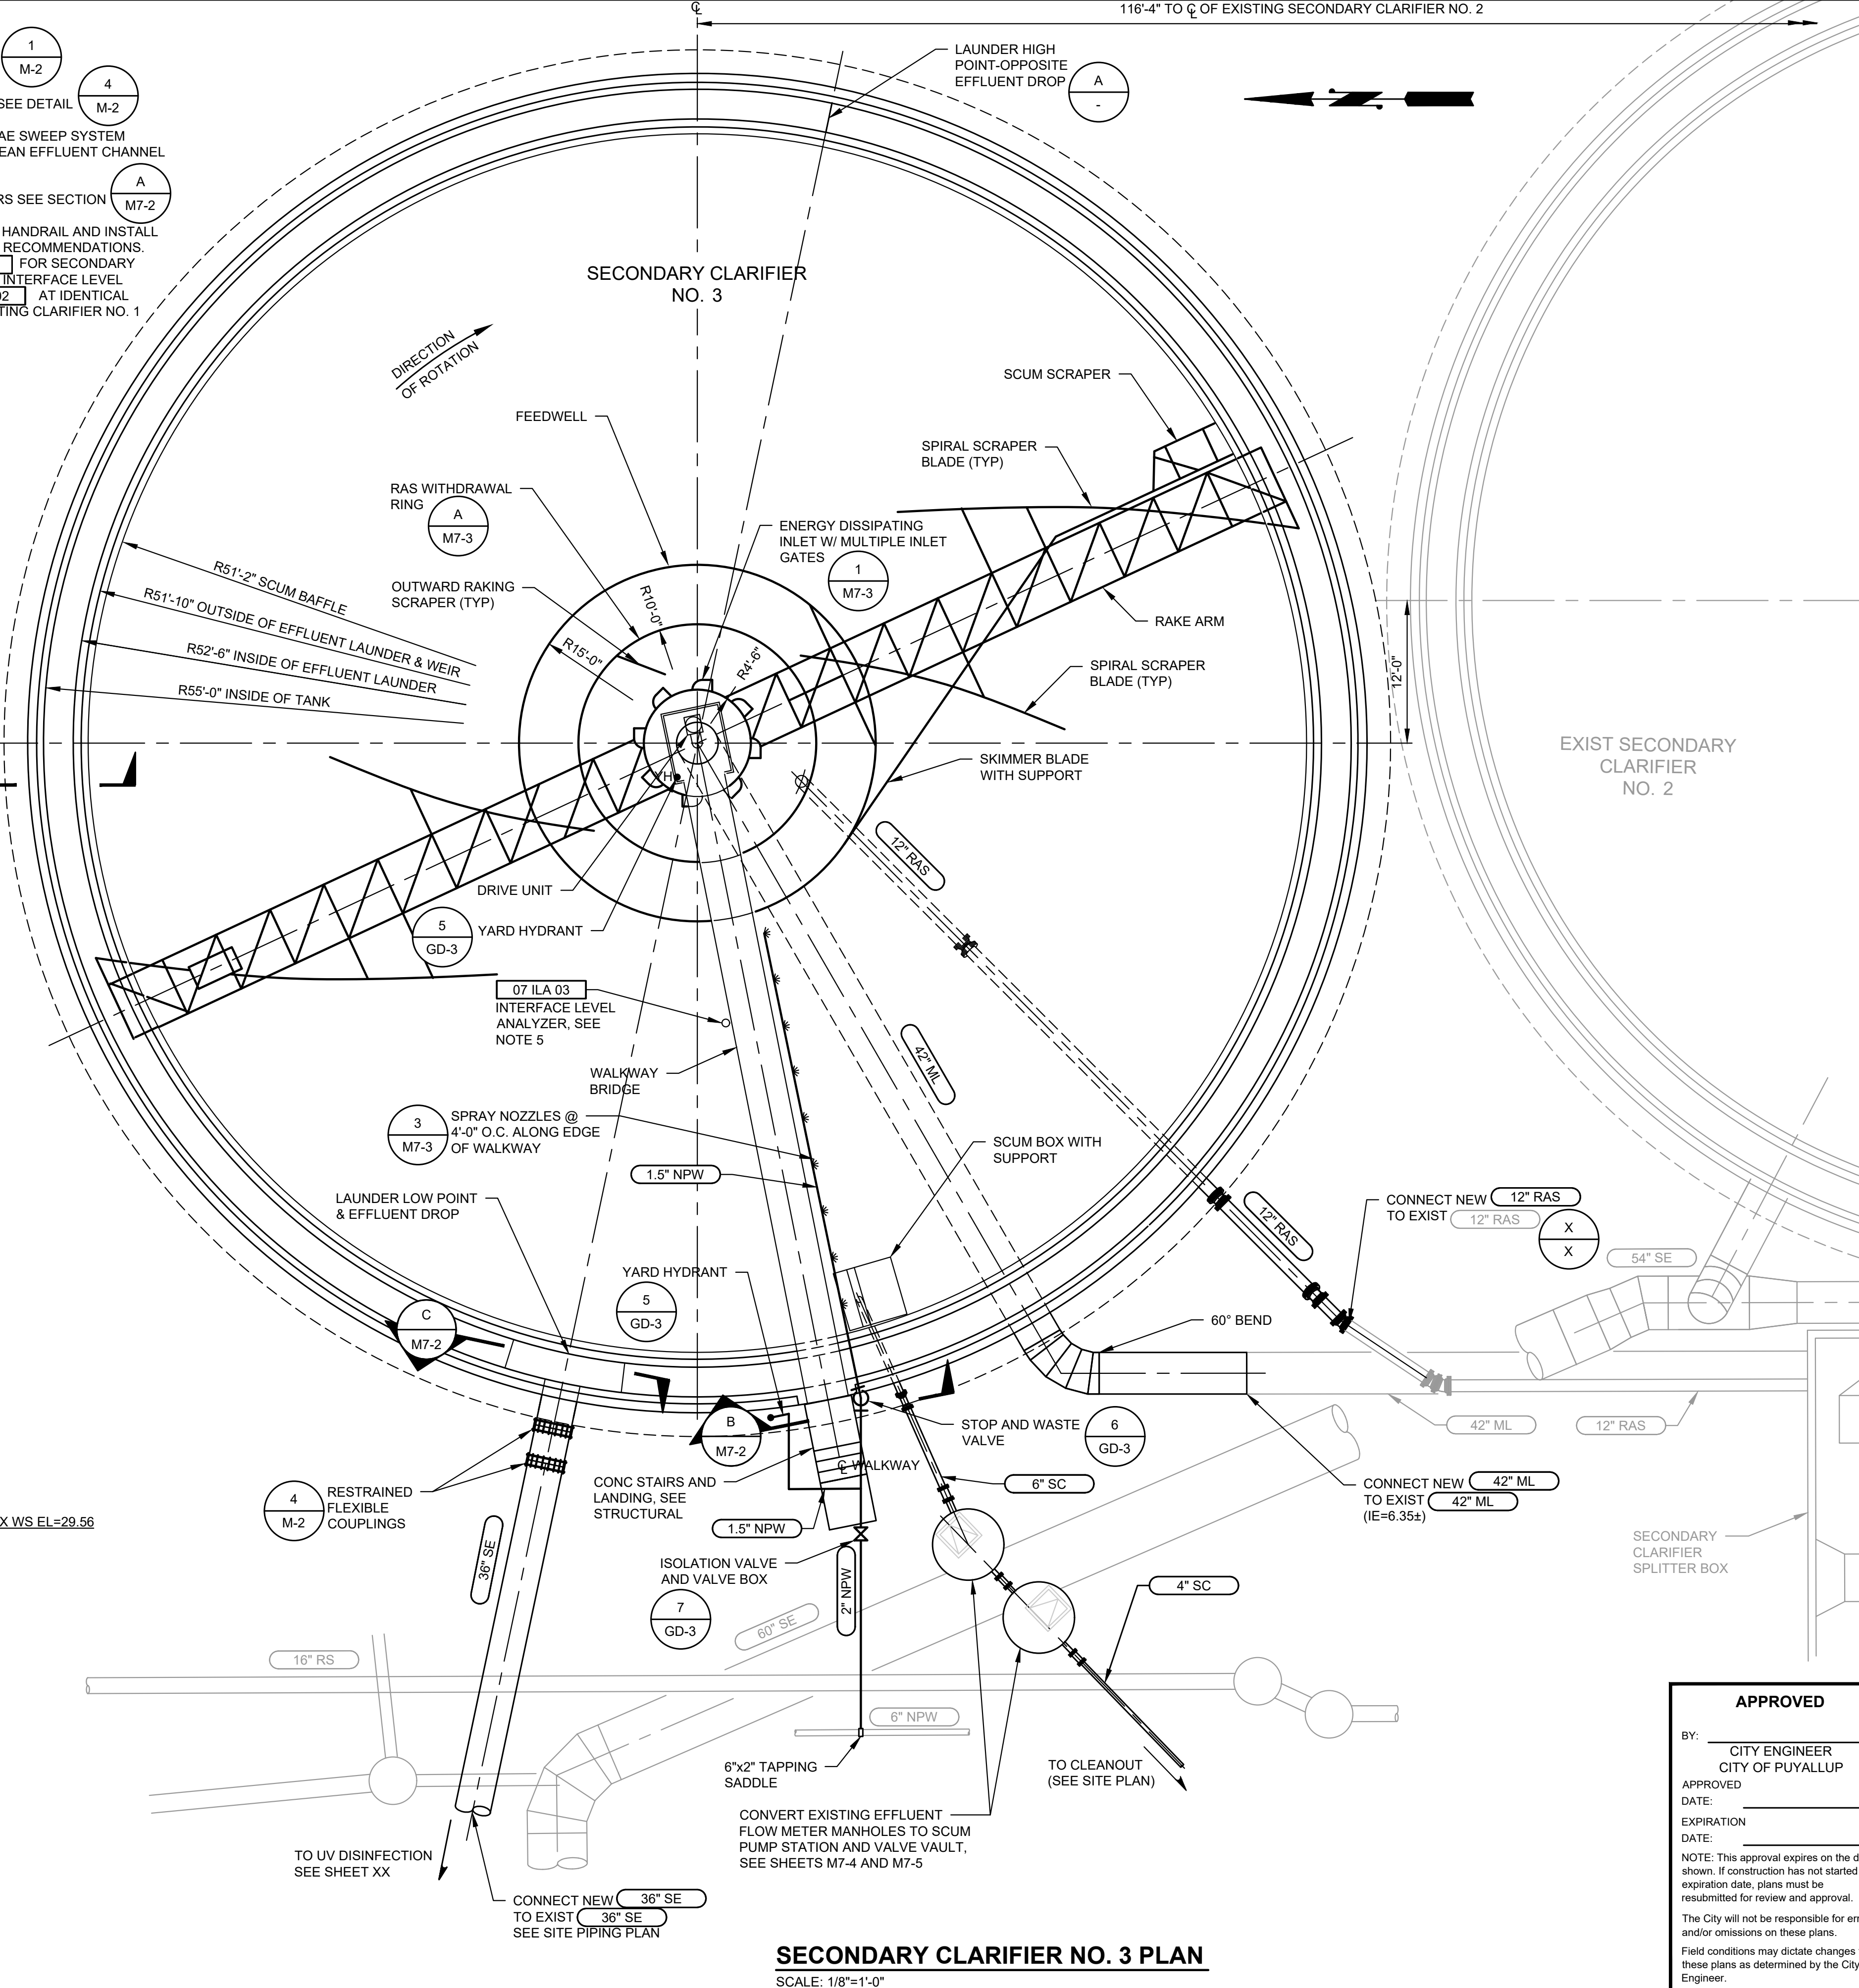

SECONDARY CLARIFIER NO. 3 PLAN

SCALE: 1/8"=1'-0"


Gray & Osborne, Inc.
CONSULTING ENGINEERS
1130 RAINIER AVENUE SOUTH, SUITE 300
SEATTLE, WASHINGTON 98144
(206) 284-0860

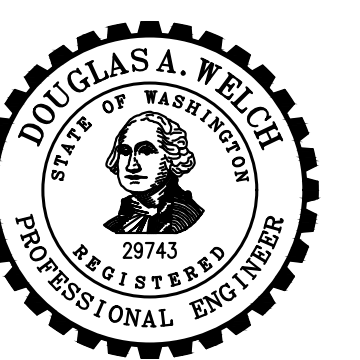

CITY OF PUYALLUP
WATER POLLUTION CONTROL PLANT THIRD SECONDARY CLARIFIER CIP NO. 20-018
1602 18TH ST NW, PUYALLUP, WA 98371

PRELIMINARY NOT FOR CONSTRUCTION

No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: XXX		
CHECKED BY: XXX		
DRAWN BY: XXX		
DESIGNER: XXX		
G & O JOB NO.: 21462		
FILE: M7_SC3-PLN.DWG		



MECHANICAL AREA 7

SECONDARY CLARIFIER NO. 3 PLAN

DRAWING: M7-1 OF 5

APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP


APPROVED DATE: _____

EXPIRATION DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans.

Field conditions may dictate changes to these plans as determined by the City Engineer.

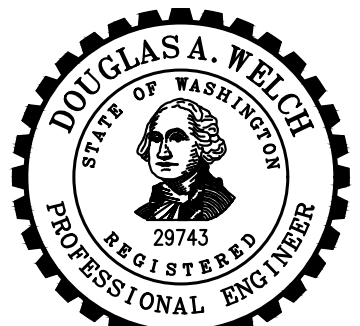

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**


No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: XXX		
CHECKED BY: XXX		
DRAWN BY: XXX		
DESIGNER: XXX		
G & O JOB NO.: 21462		
FILE: M7_SC3-PLN.DWG		

0 1" 2"
TWO INCHES AT FULL SCALE.
IF NOT, SCALE ACCORDINGLY

**MECHANICAL
AREA 7**

**SECONDARY
CLARIFIER NO. 3
SECTIONS**


DRAWING: **M7-2** OF: **5**

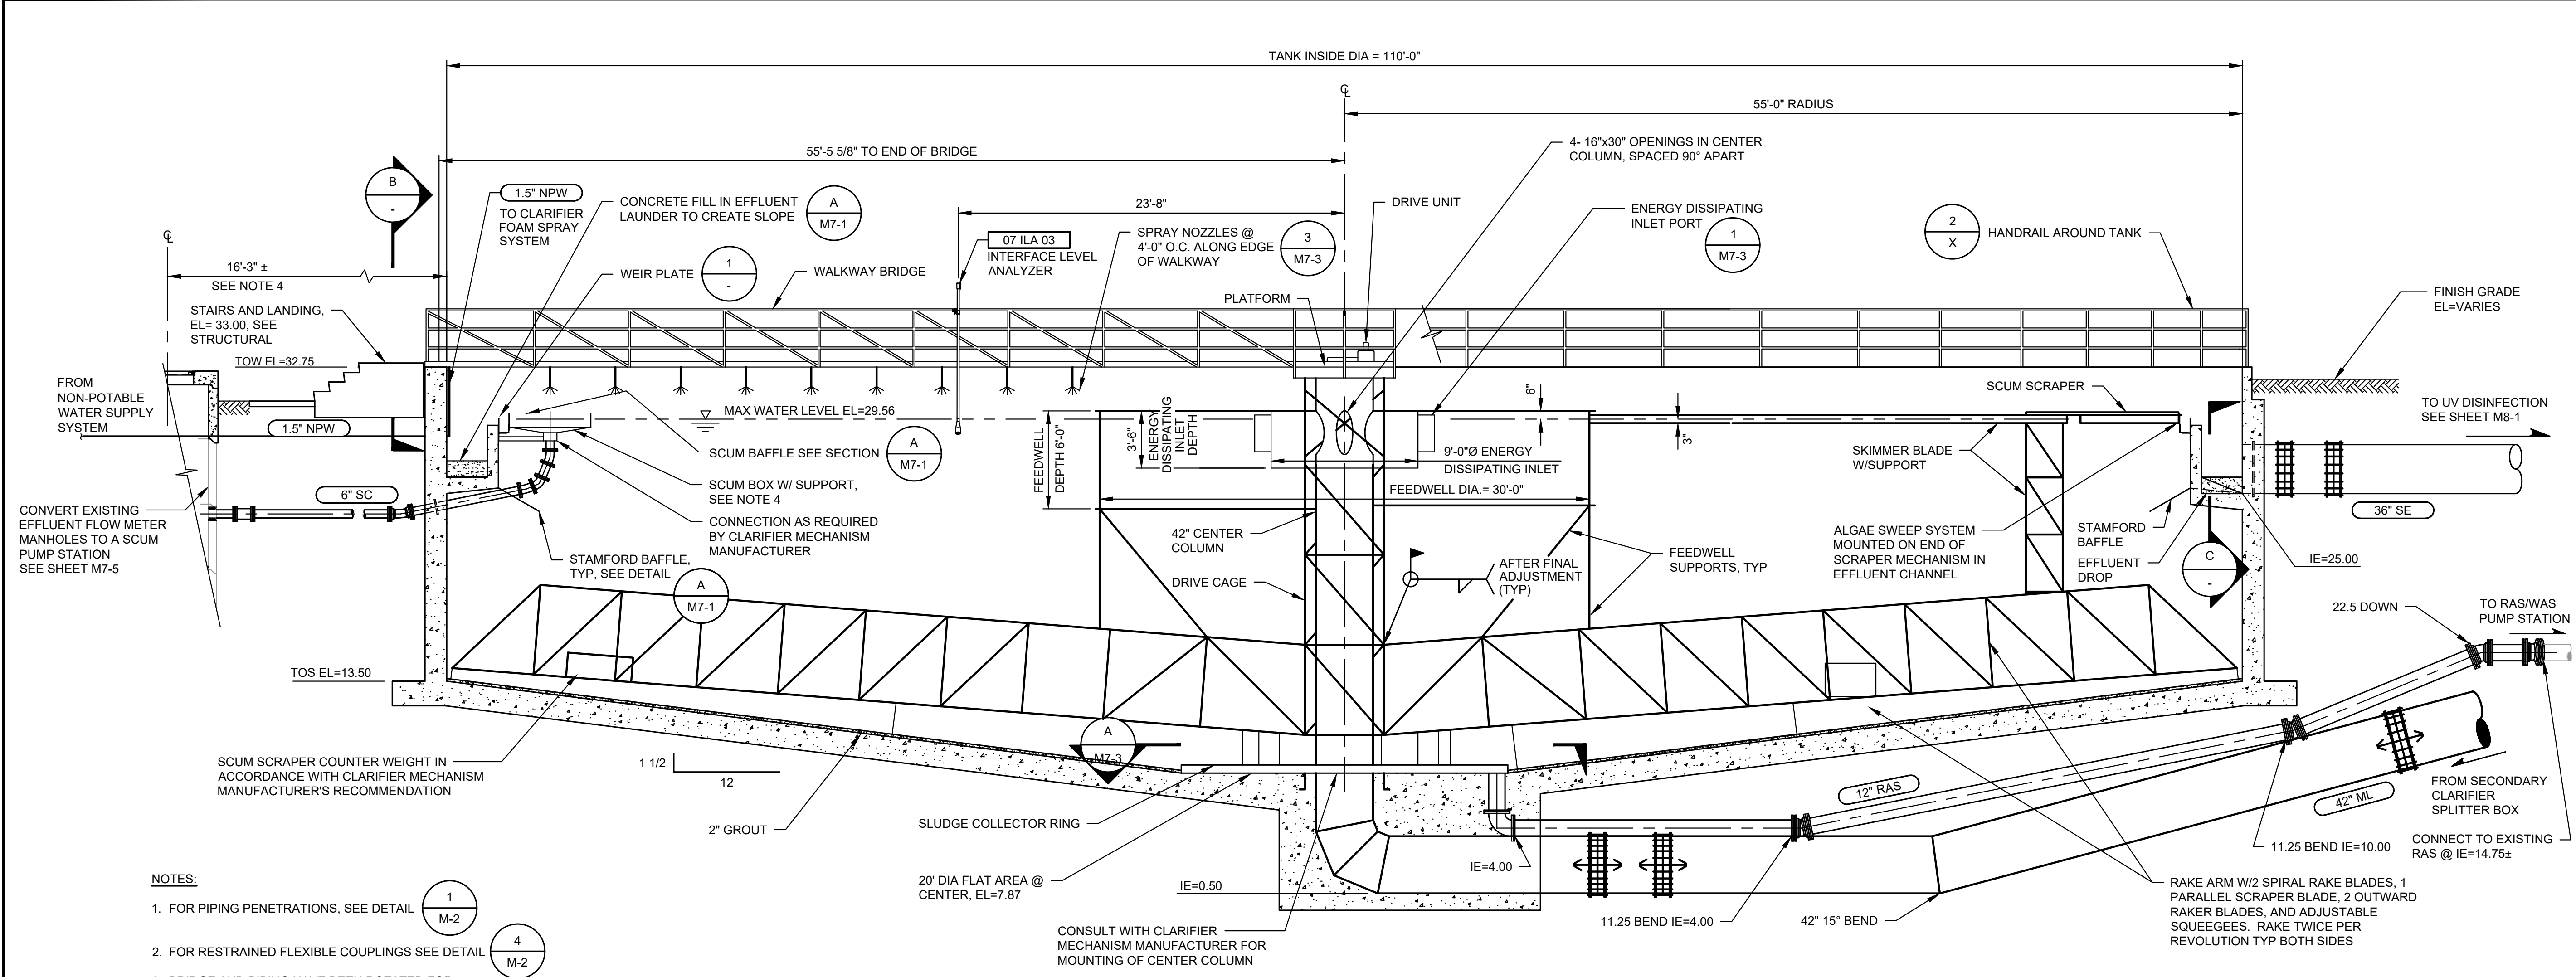


SECTION A
M7-1
SCALE: 3/16"=1'-0"

- NOTES:**
- FOR PIPING PENETRATIONS, SEE DETAIL M-2
 - FOR RESTRAINED FLEXIBLE COUPLINGS SEE DETAIL 4 M-2
 - BRIDGE AND PIPING HAVE BEEN ROTATED FOR CLARITY. SEE SHEET M7-1 FOR ORIENTATION.
 - SCUM BOX AND SCUM PUMP STATION ROTATED FOR CLARITY, SEE SHEETS M7-1 AND M7-5 FOR ORIENTATION.


NOTE:
THE CLARIFIER MECHANISM MANUFACTURER SHALL DESIGN THE WALKWAY BRIDGE IN ACCORDANCE WITH ALL APPLICABLE CODES, SUBJECT TO REVIEW BY THE ENGINEER

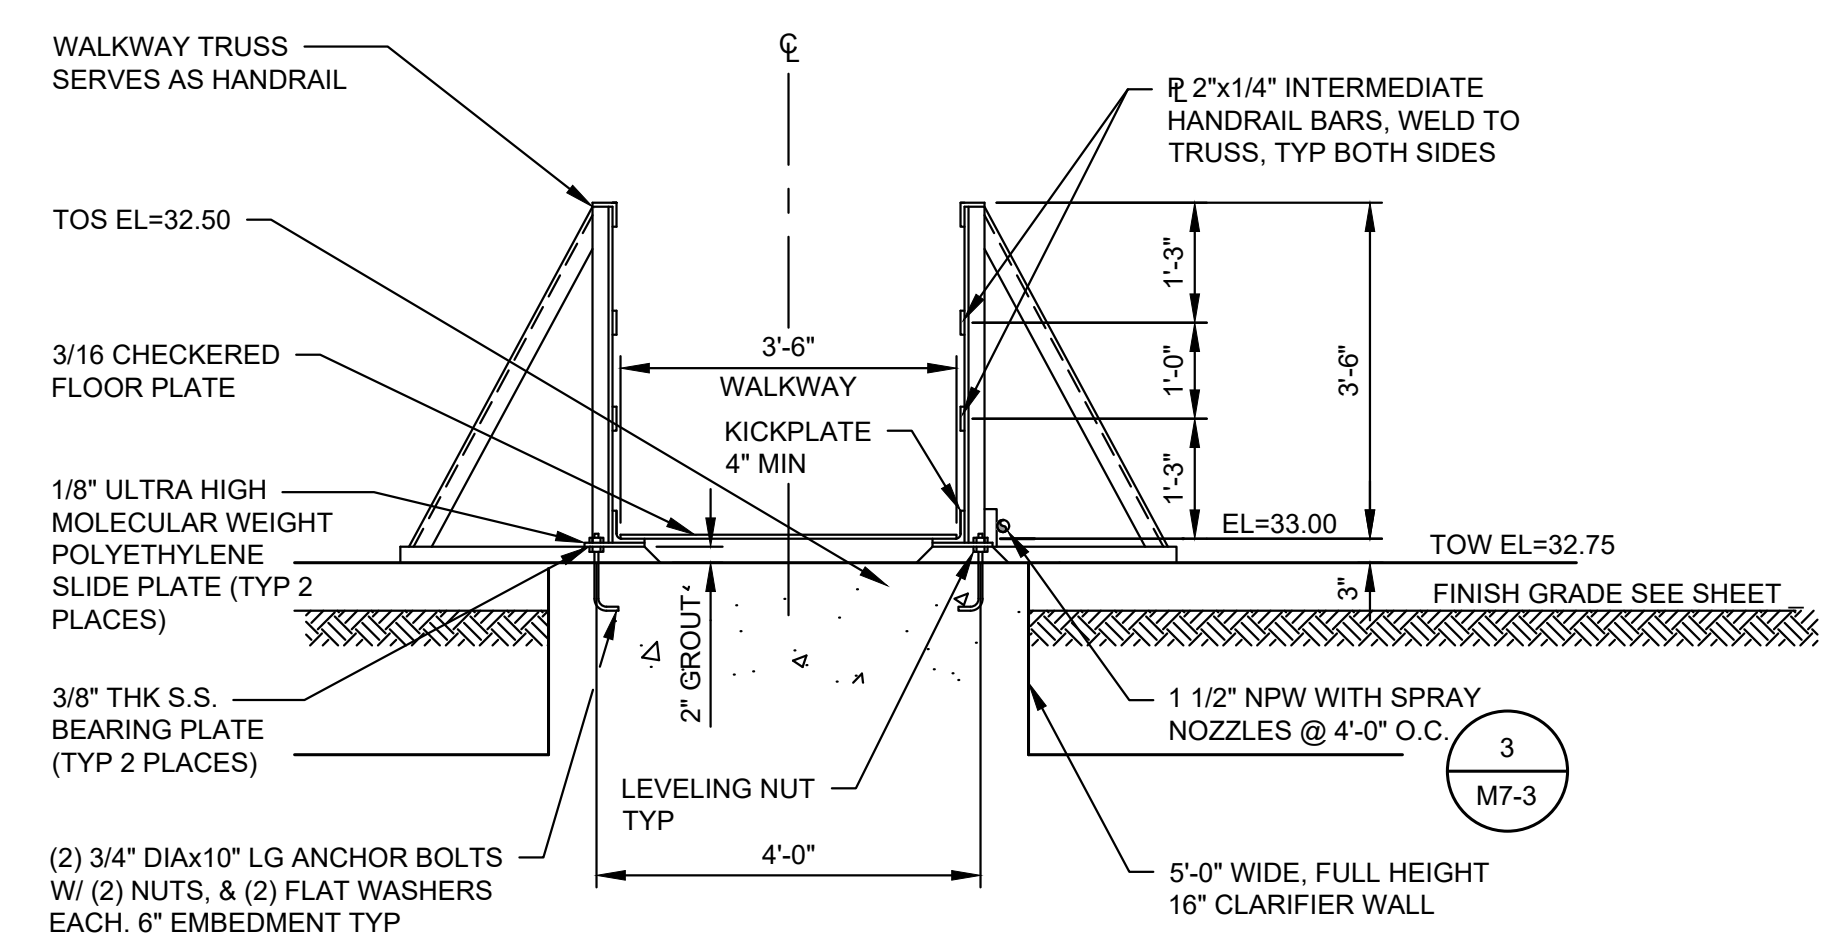

SECTION B
M7-1
SCALE: 1/2"=1'-0"

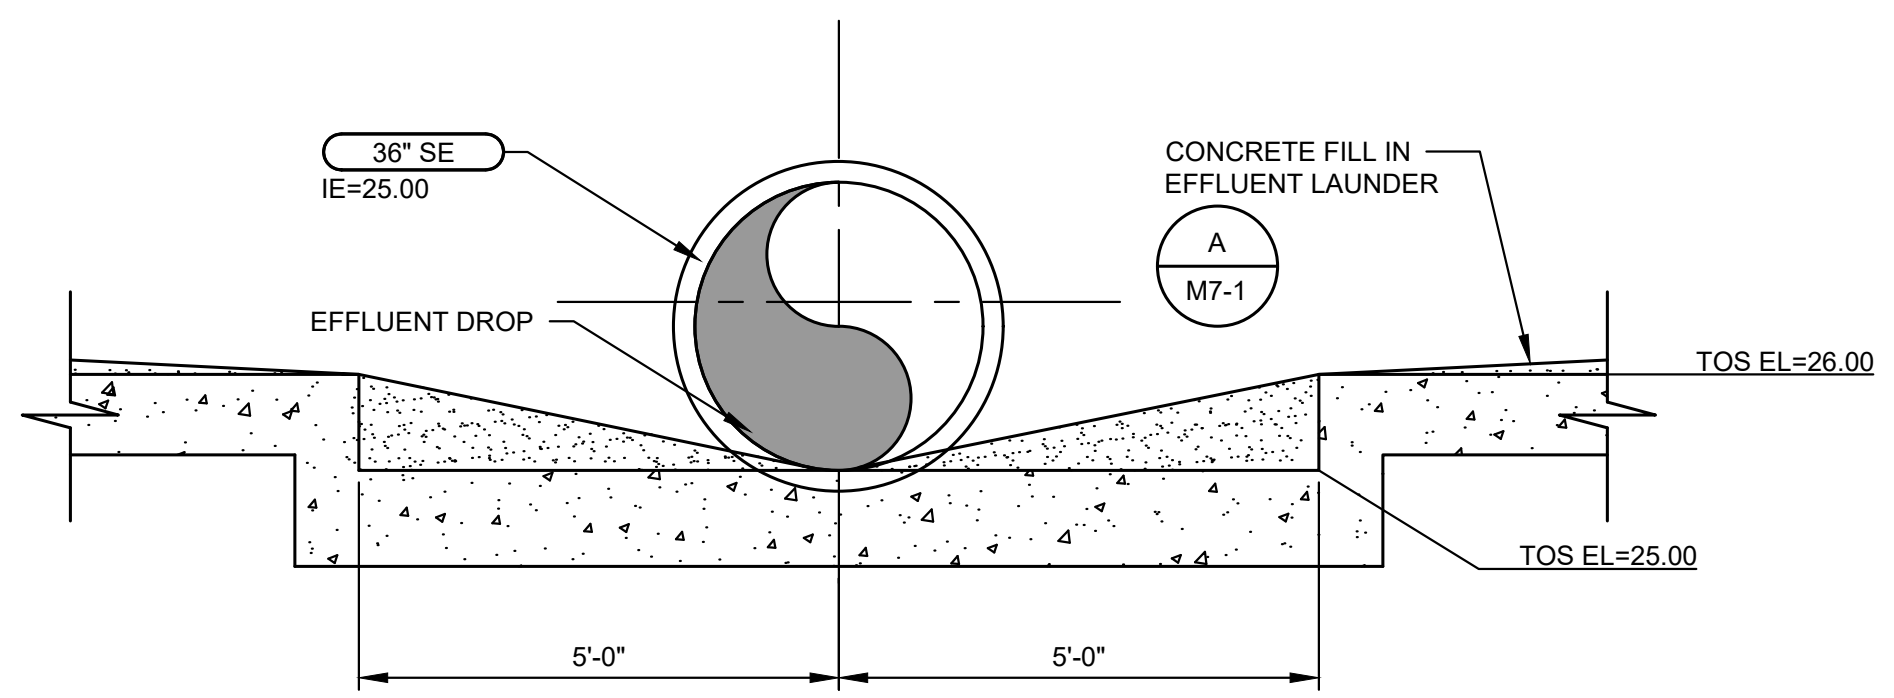

SECTION C
M7-1
SCALE: 1/2"=1'-0"

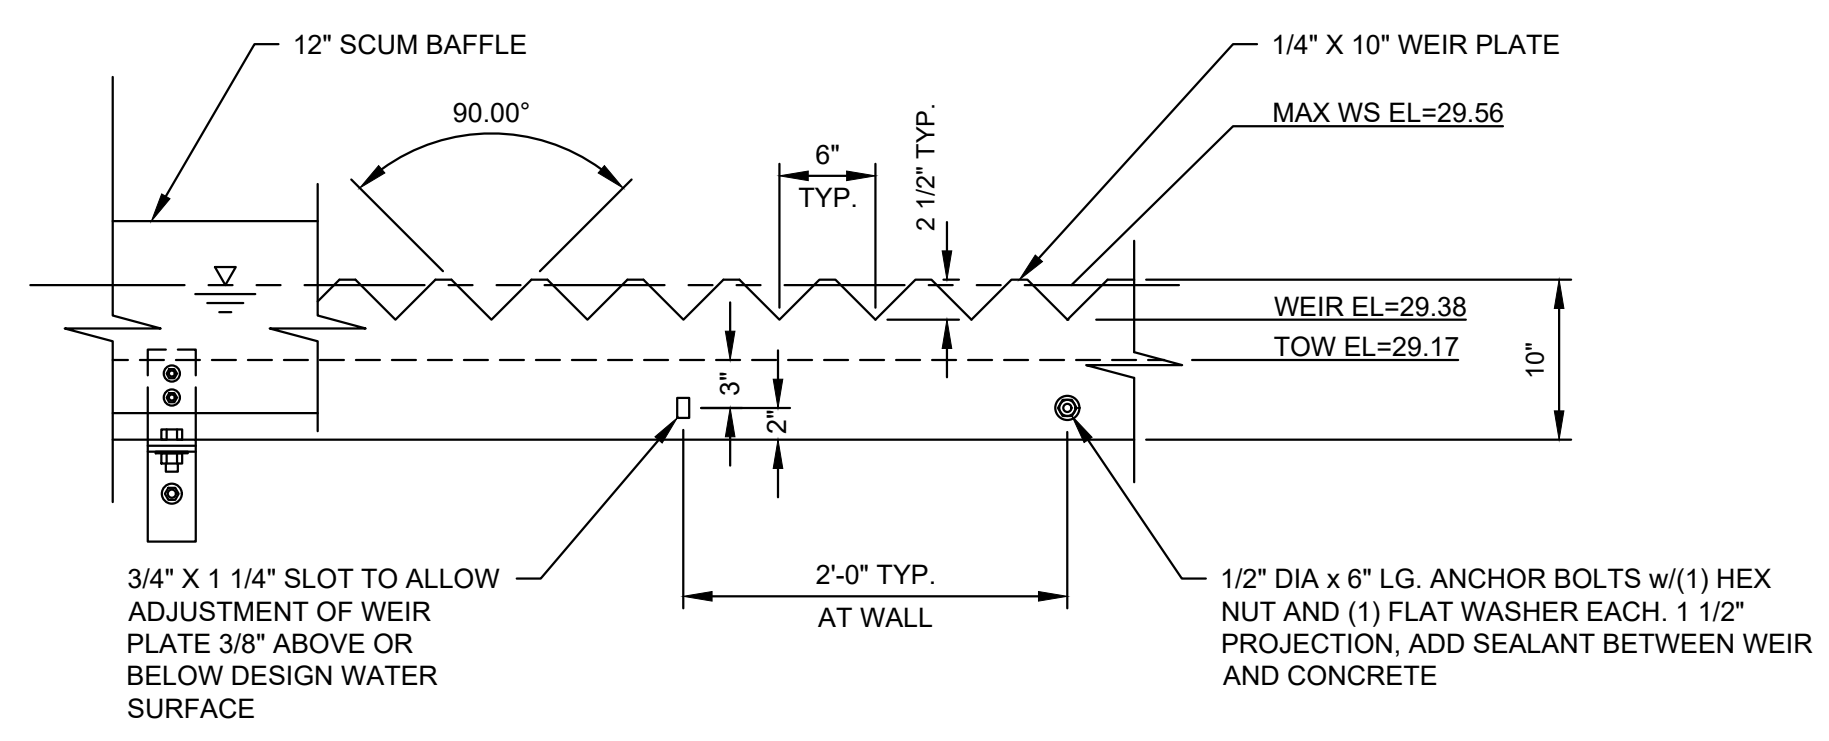

- NOTES:**
- ALL NUTS, BOLTS, AND WASHERS SHALL BE 316 SS.
 - INSTALL NEOPRENE GASKET BETWEEN WEIR BLADE AND CONCRETE. CAULK TOP AND BOTTOM JOINTS W/ ELASTOMERIC SEALANT AFTER INSTALLATION.

1 WEIR DETAIL
SCALE: 1"=1'-0"

APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP

APPROVED DATE: _____



EXPIRATION DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans.

Field conditions may dictate changes to these plans as determined by the City Engineer.


m:\PUYALLUP\21462 wpcp 3rd secondary clarifier\01 design\PlanSet\Mechanical\M7_SC3-PLN.dwg, 1/3/2022 1:59 PM, CHARLEY REID

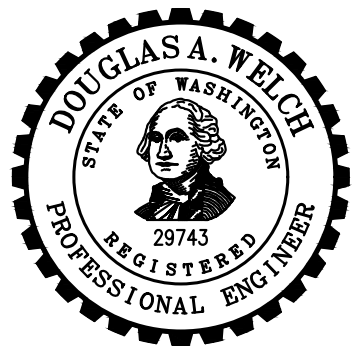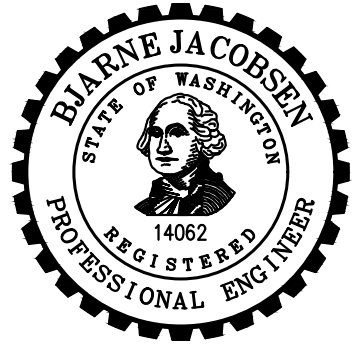

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**


No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: XXX		
CHECKED BY: XXX		
DRAWN BY: XXX		
DESIGNER: XXX		
G & O JOB NO.: 21462		
FILE: M7_SC3-PLN.DWG		




**MECHANICAL
AREA 7**

**SECONDARY CLARIFIER NO. 3
SECTIONS AND
DETAILS**


DRAWING: **M7-3** OF: **5**

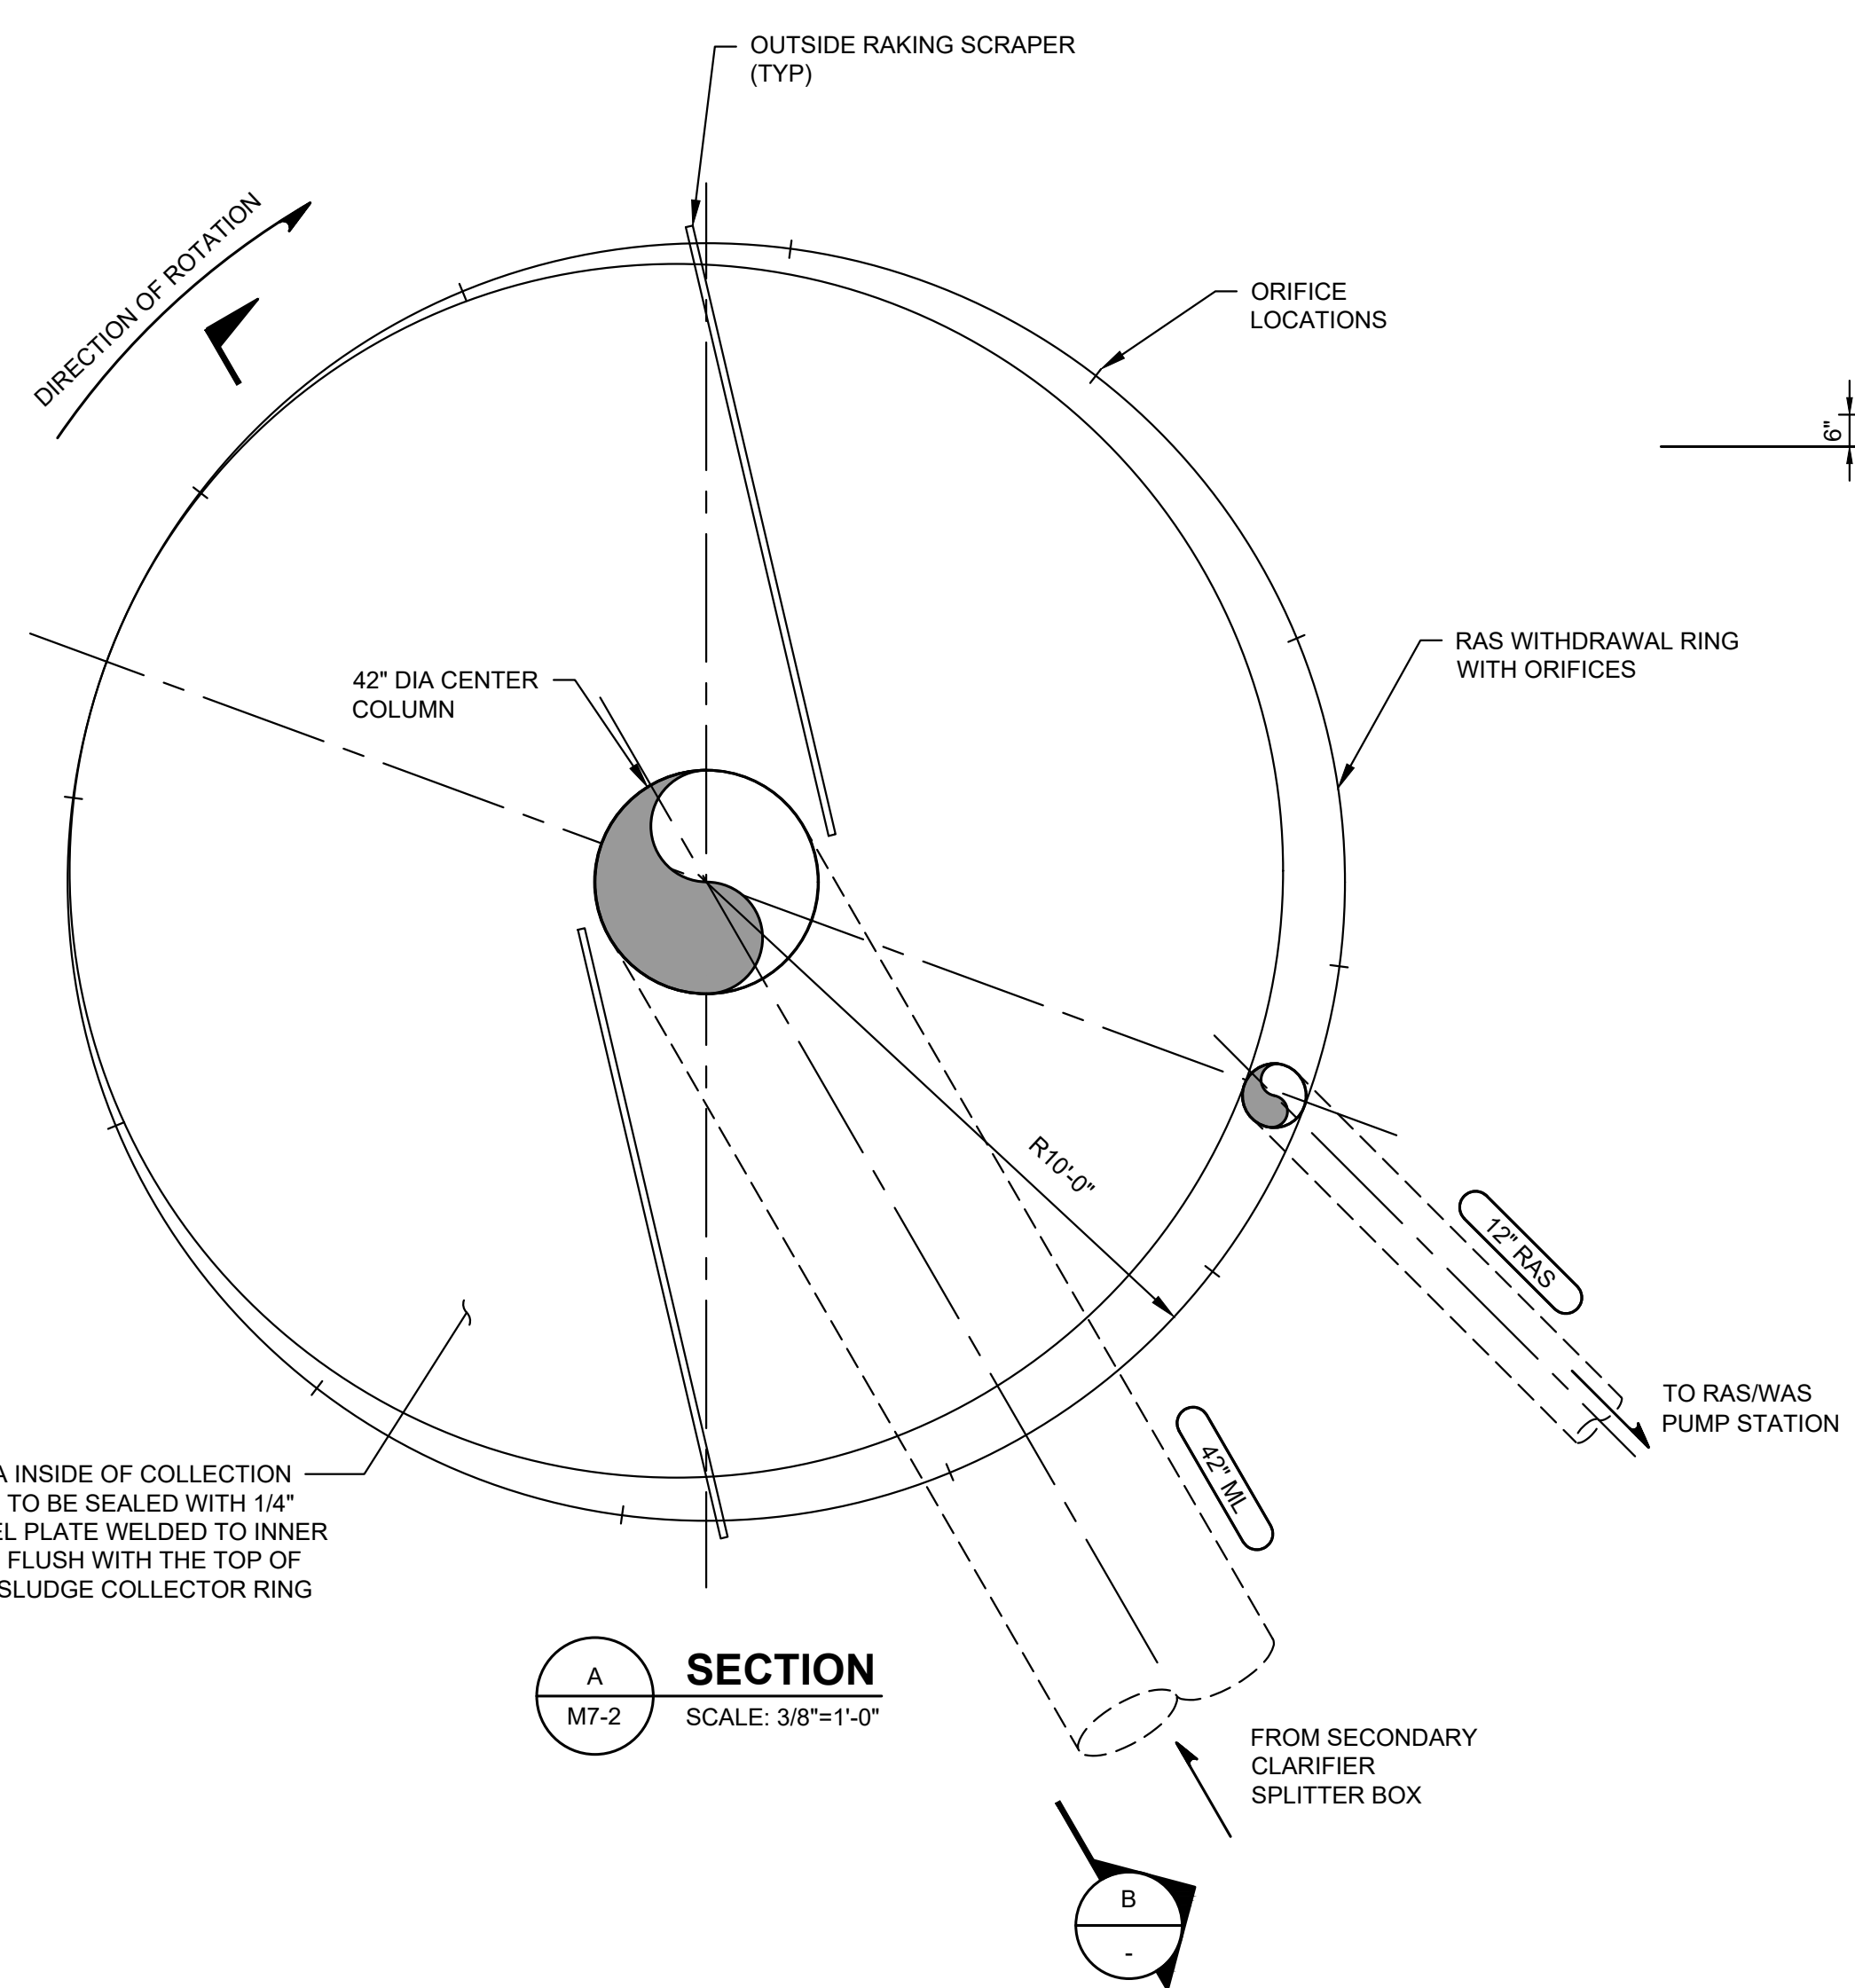


SECTION A
M7-2
SCALE: 3/8"=1'-0"

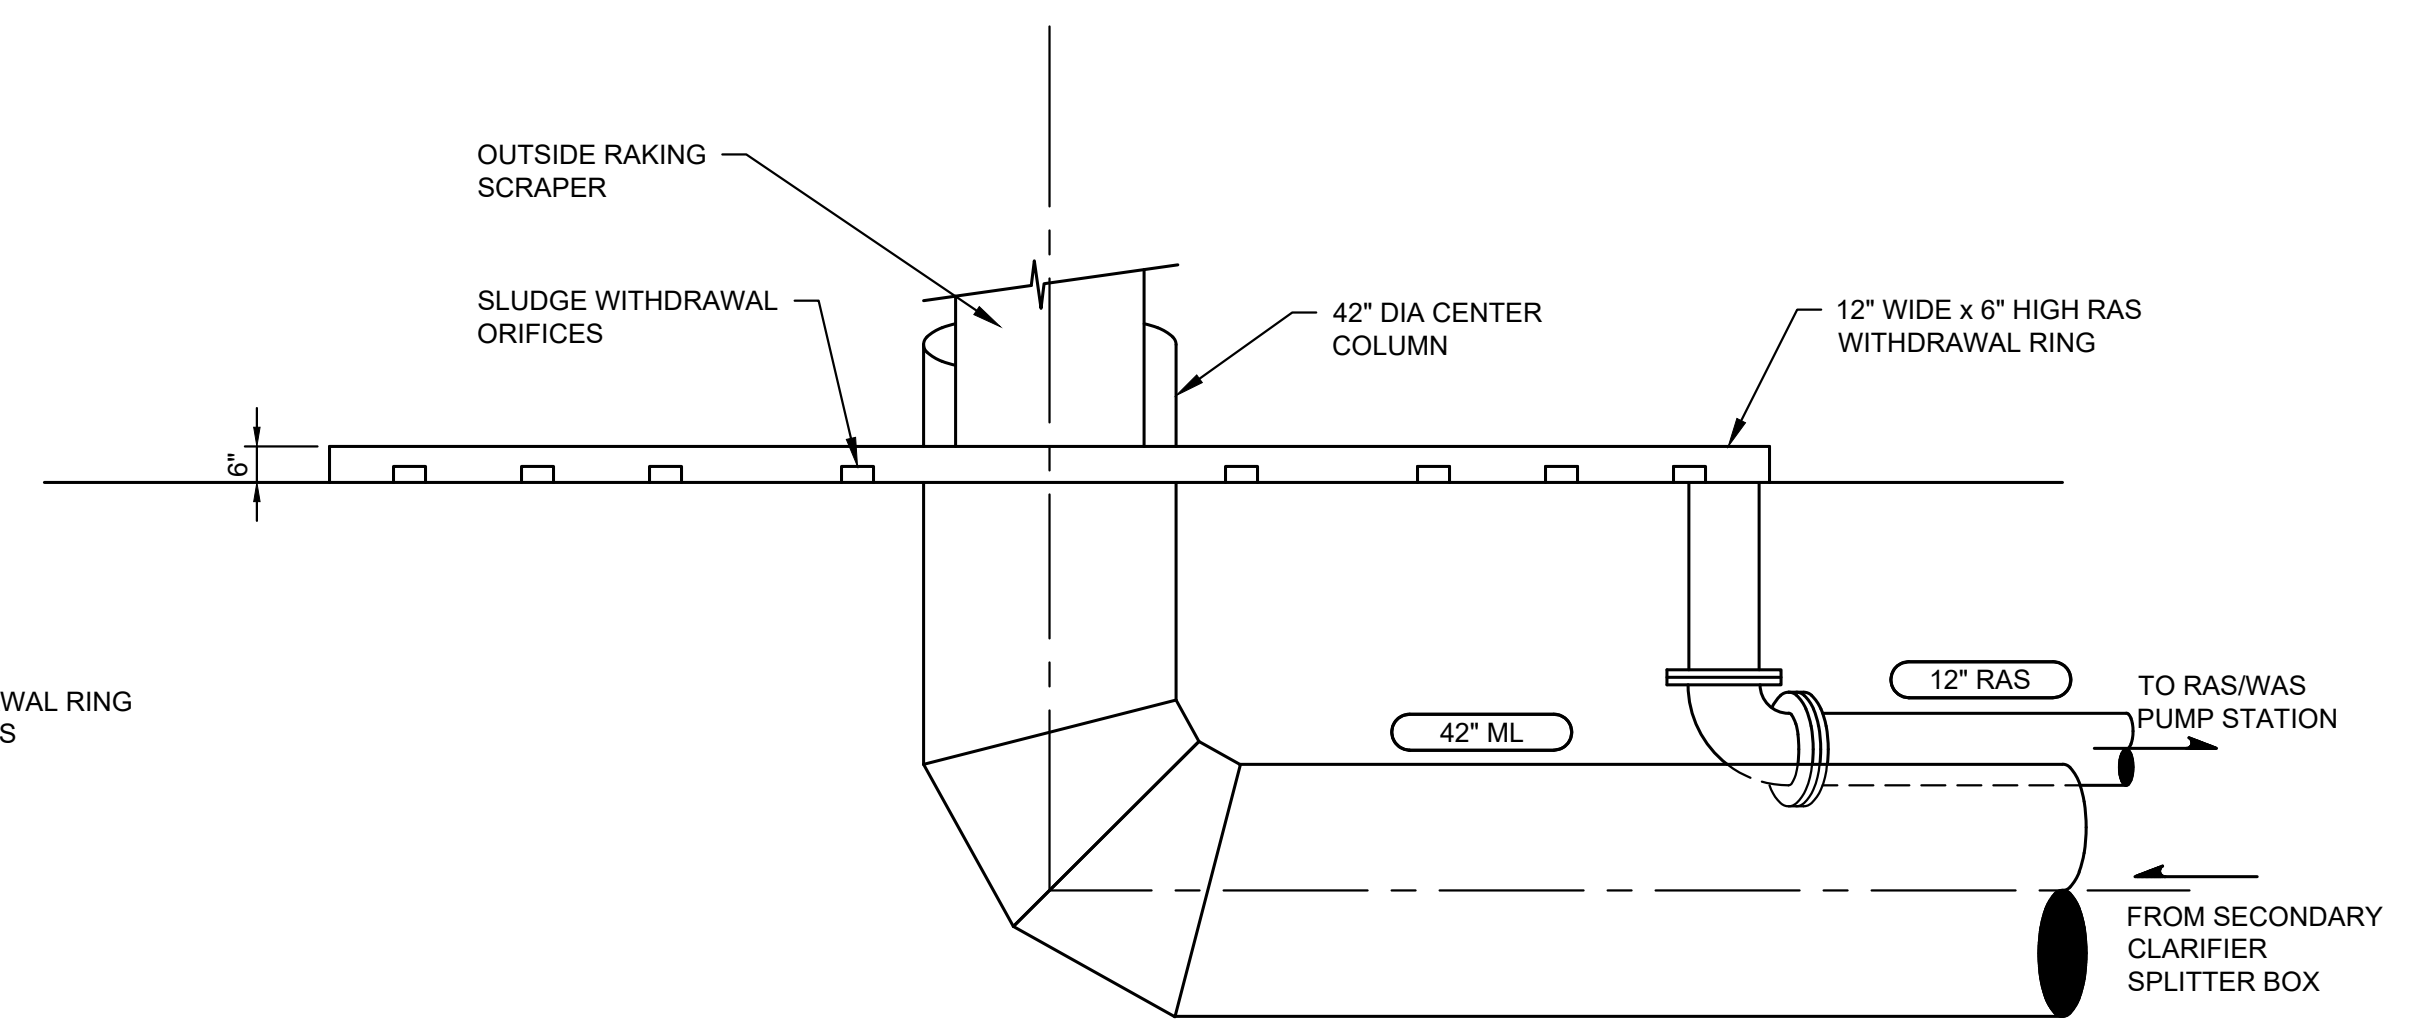


SECTION B
SCALE: 3/8"=1'-0"

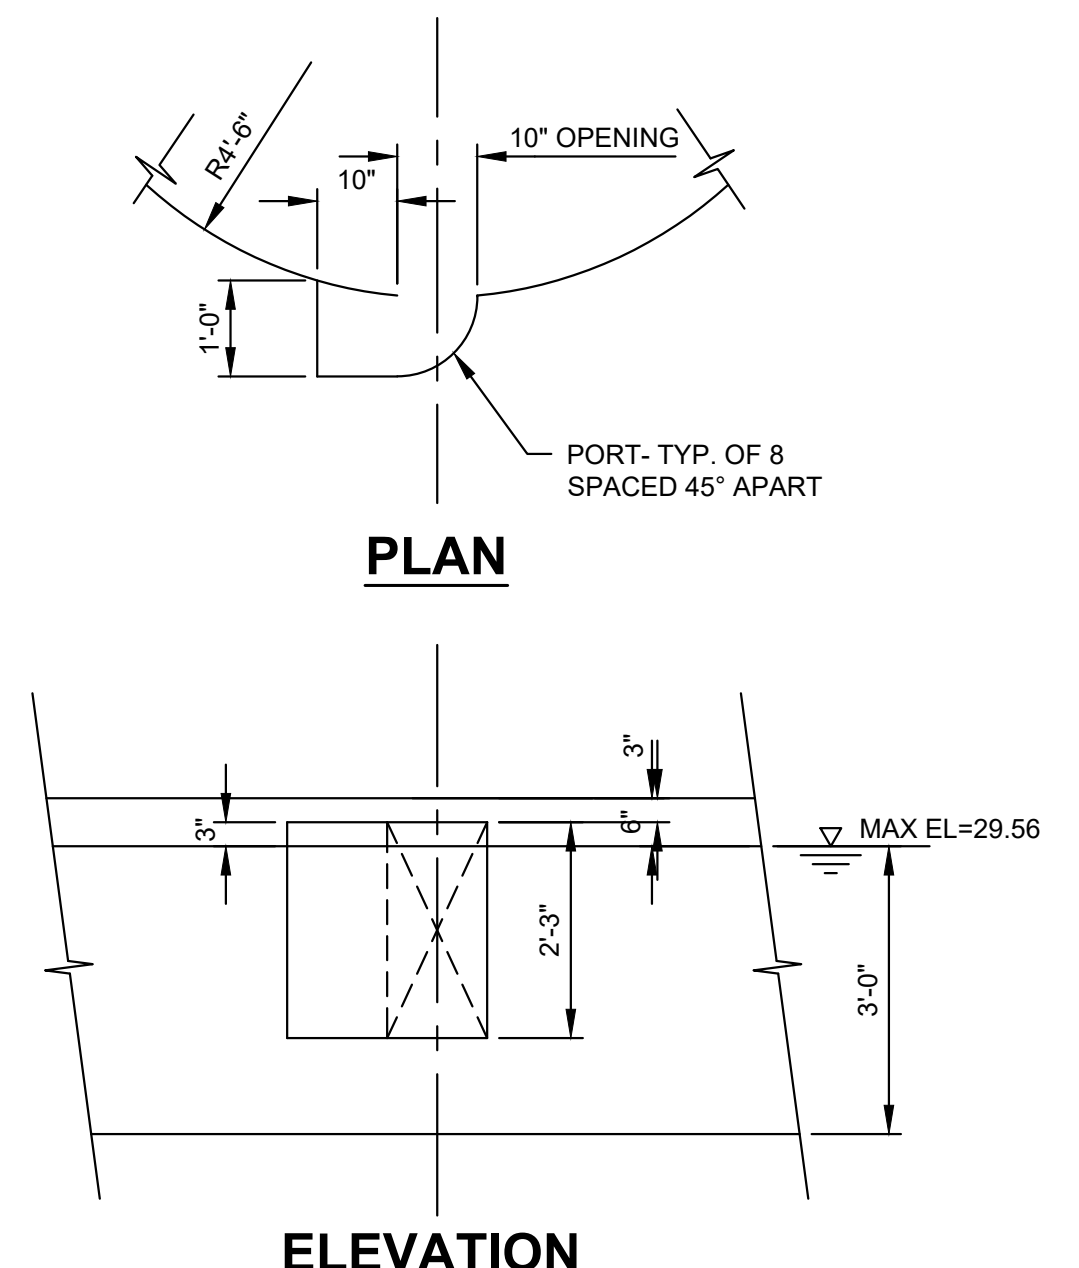

1 ENERGY DISSIPATING INLET PORT DETAIL
M7-1
SCALE: 1/2"=1'-0"

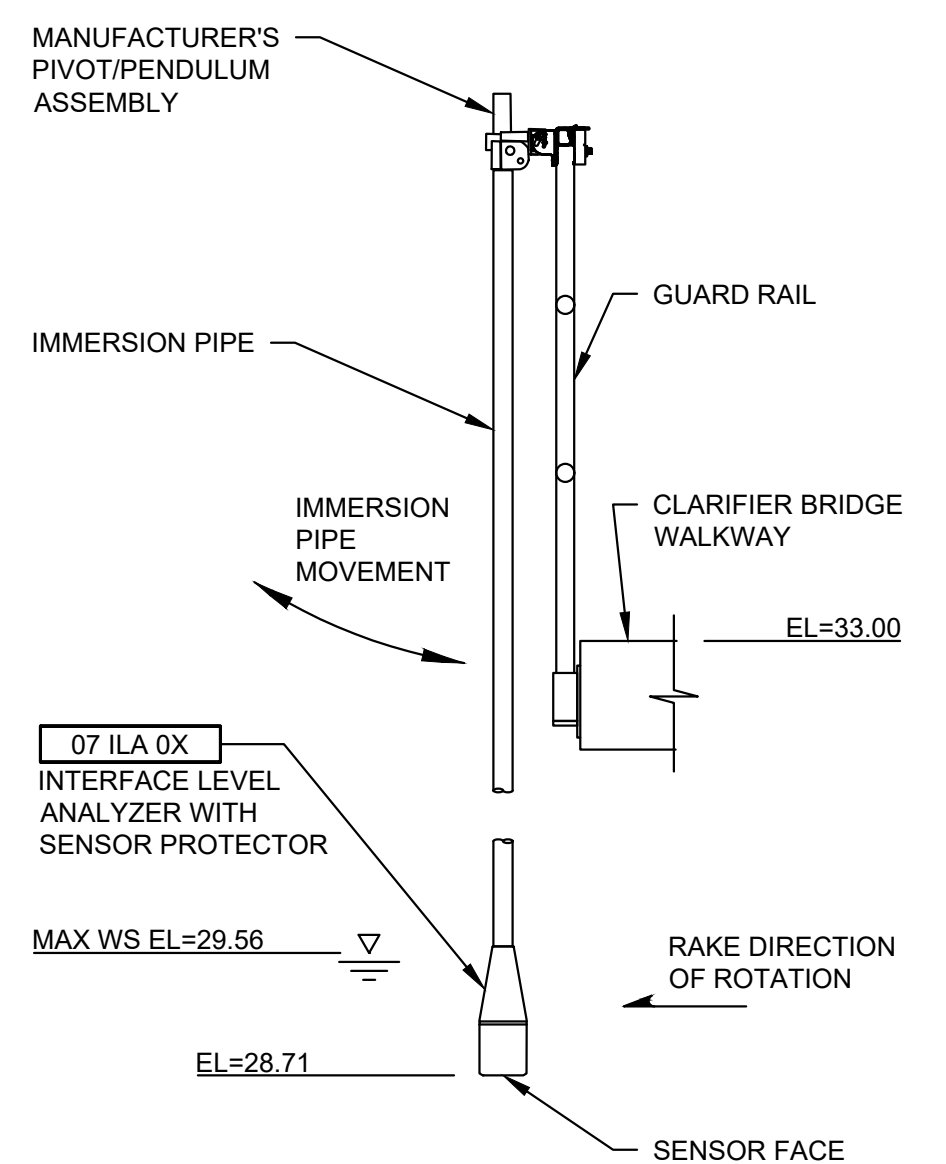

2 INTERFACE LEVEL ANALYZER DETAIL
M7-1
SCALE: 3/4"=1'-0"

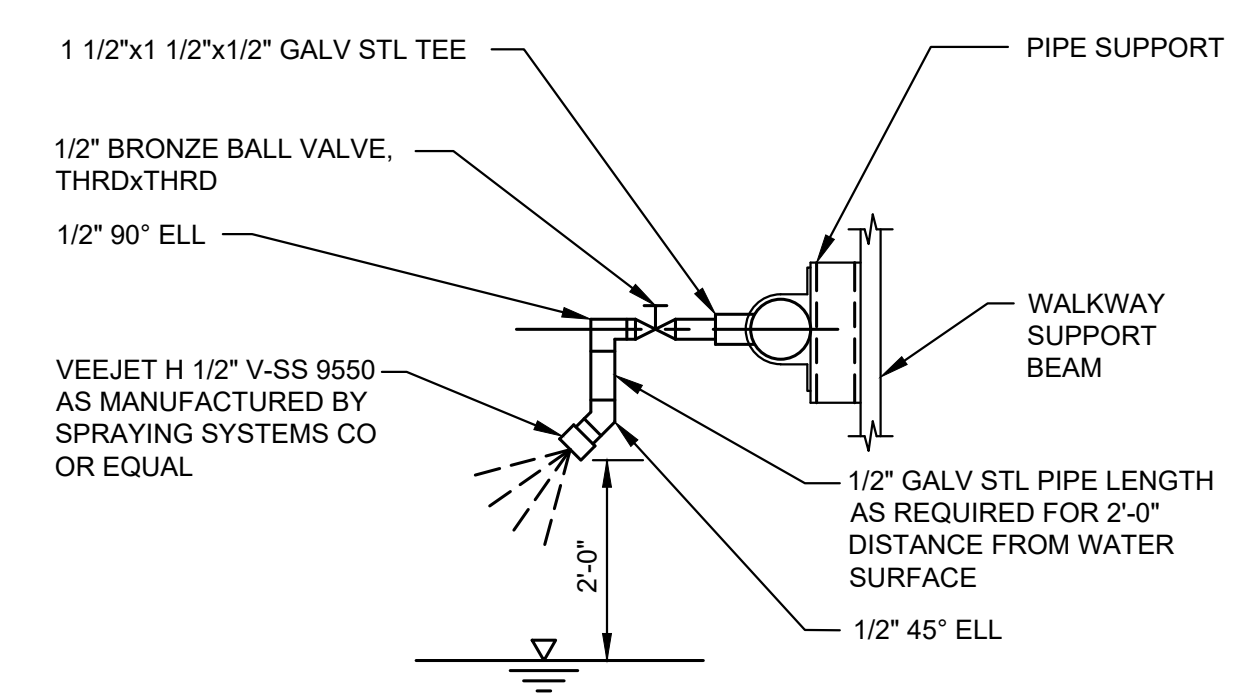

3 SPRAY NOZZLES DETAIL
TYP
NOT TO SCALE

APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP

APPROVED DATE: _____
EXPIRATION DATE: _____


NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans.

Field conditions may dictate changes to these plans as determined by the City Engineer.

m:\PUYALLUP\21462\wpcp\3rd\secondary clarifier\01 design\Plan\Mechanical\M7_SC3-PLN.dwg, 1/3/2022 1:59 PM, CHARLEY REID


m:\PUYALLUP\21462\wpcp 3rd secondary clarifier\01 design\PlanSet\Mechanical\M7_SCUM-PS-PLN.dwg, 1/3/2022 1:59 PM, CHARLEY REID

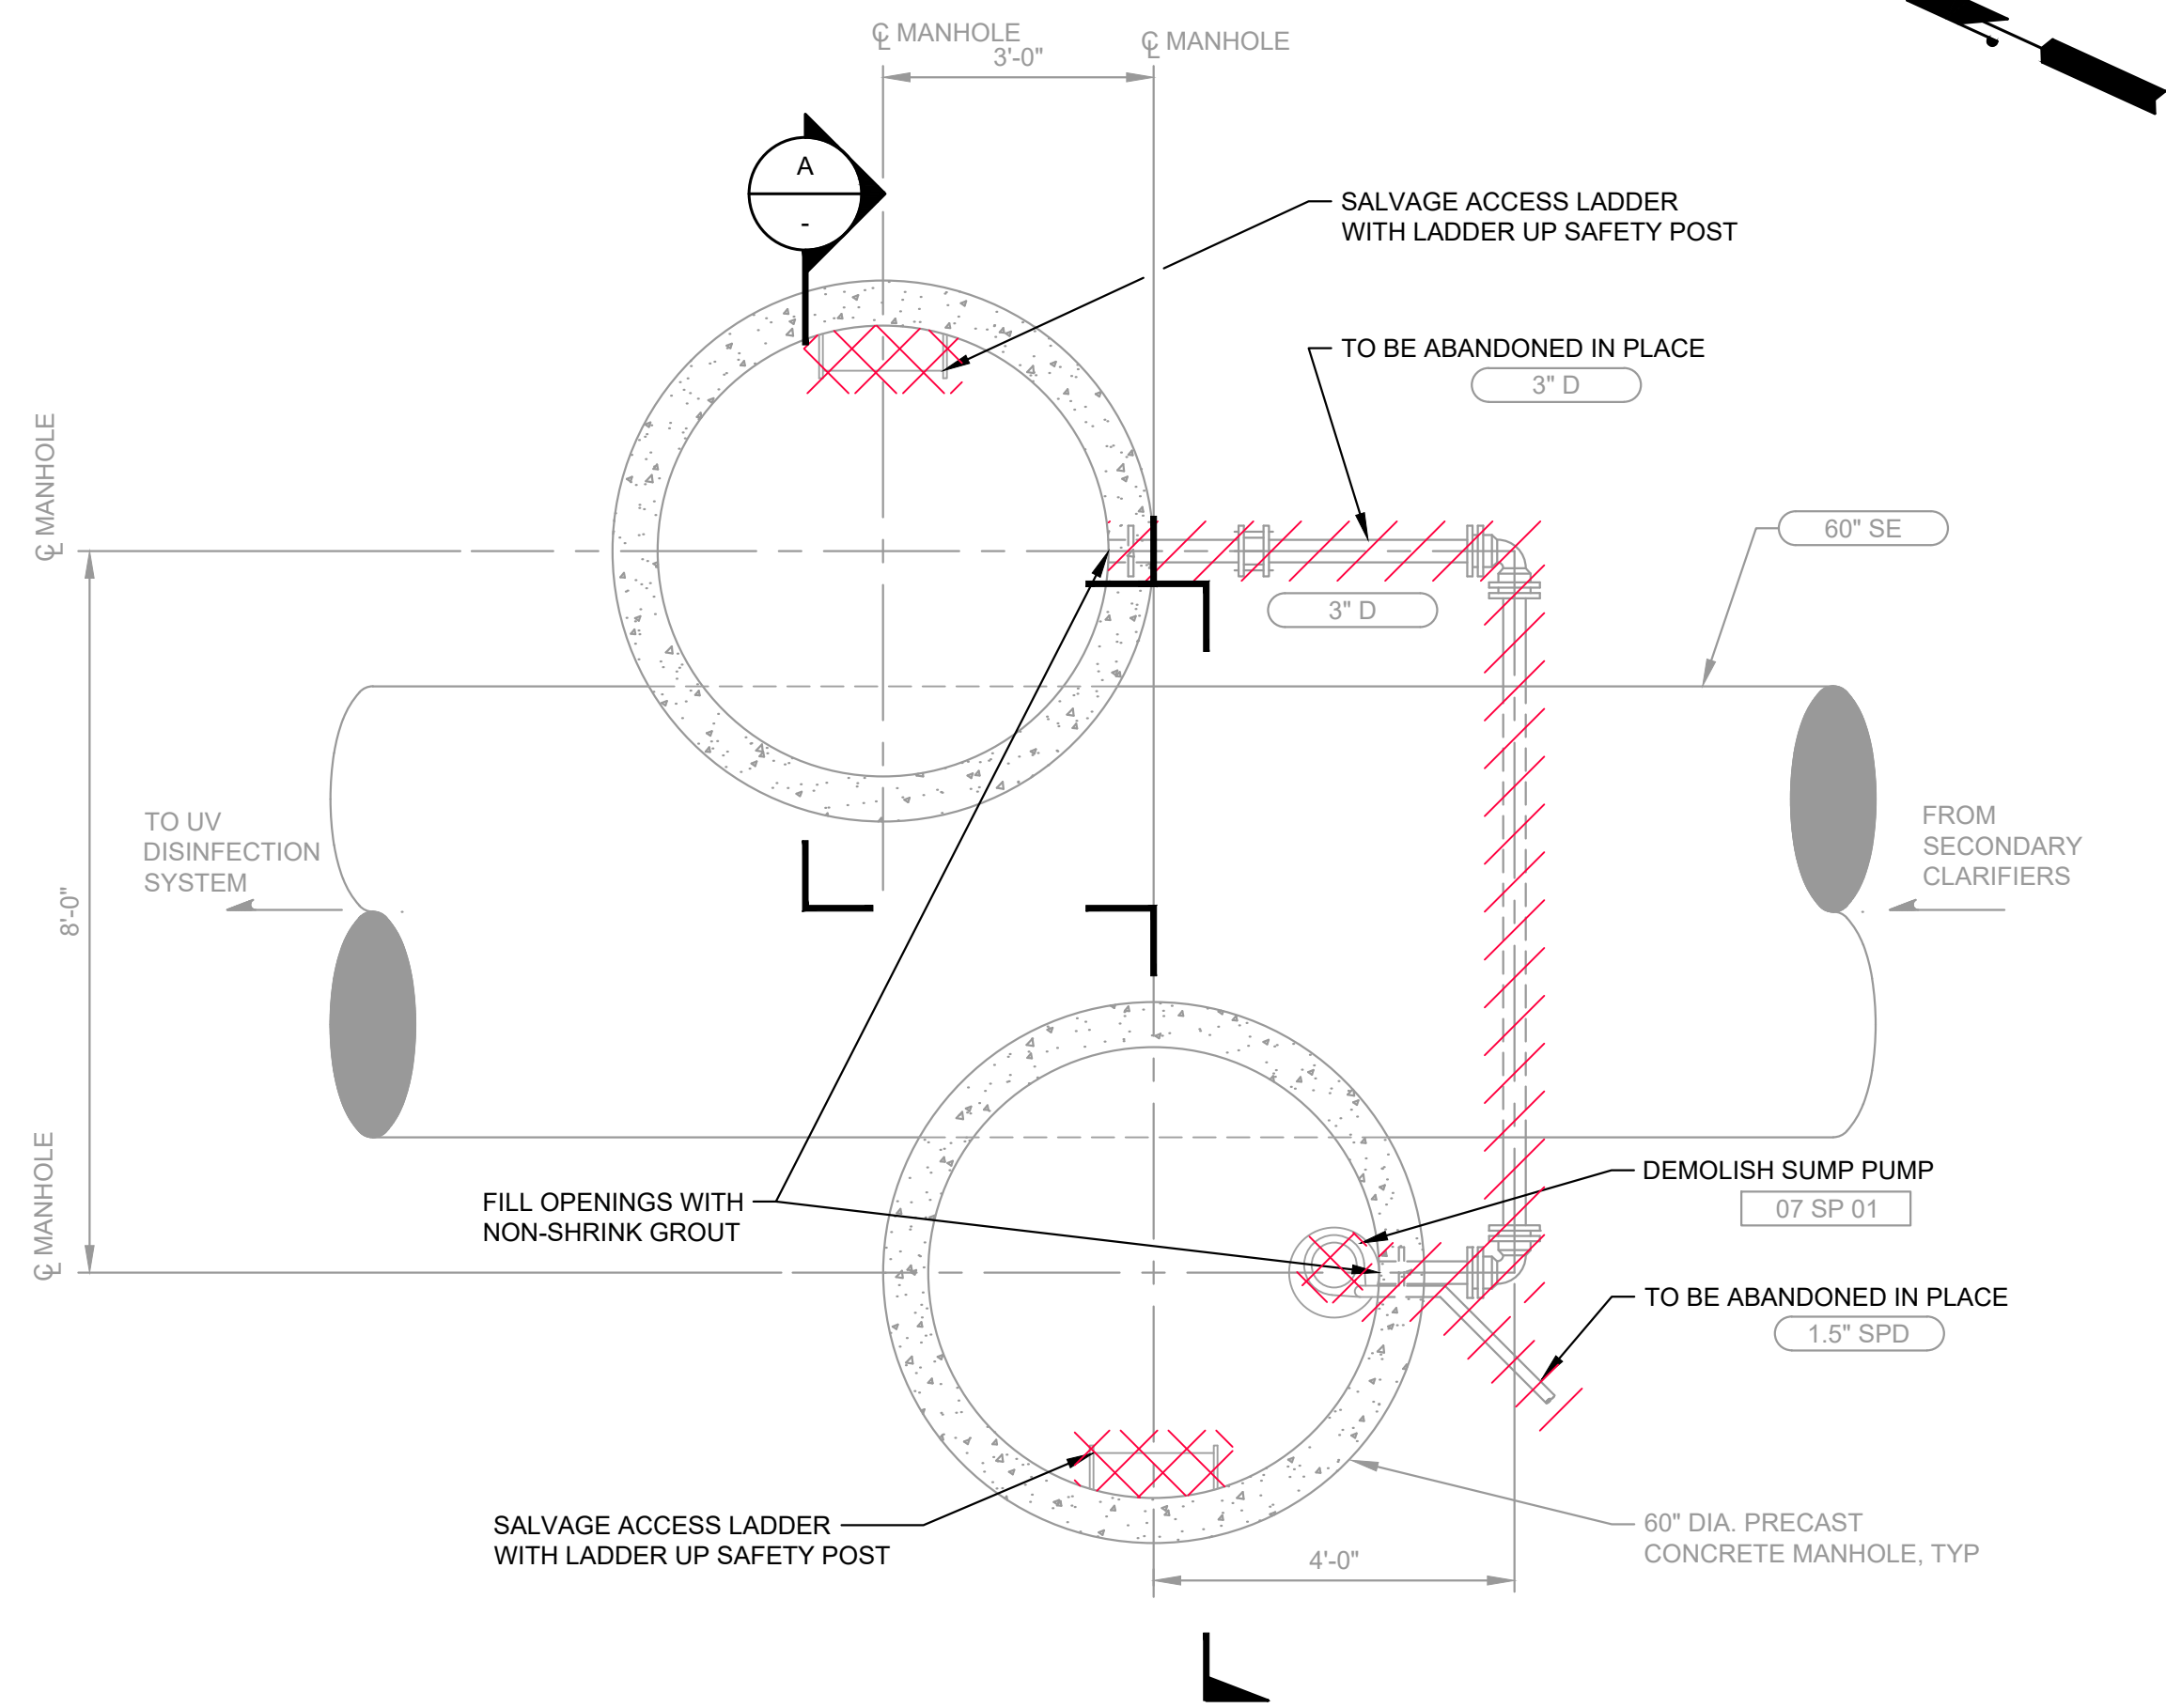


**EXISTING EFFLUENT FLOW METER
MANHOLE DEMOLITION PLAN**
SCALE: 1/2"=1'-0"

LEGEND:

- DENOTES ITEMS TO BE DEMOLISHED BY CONTRACTOR IN ACCORDANCE WITH THE PLANS AND SPECIFICATIONS
- DENOTES ITEMS TO BE ABANDONED IN PLACE BY CONTRACTOR IN ACCORDANCE WITH THE PLANS AND SPECIFICATIONS

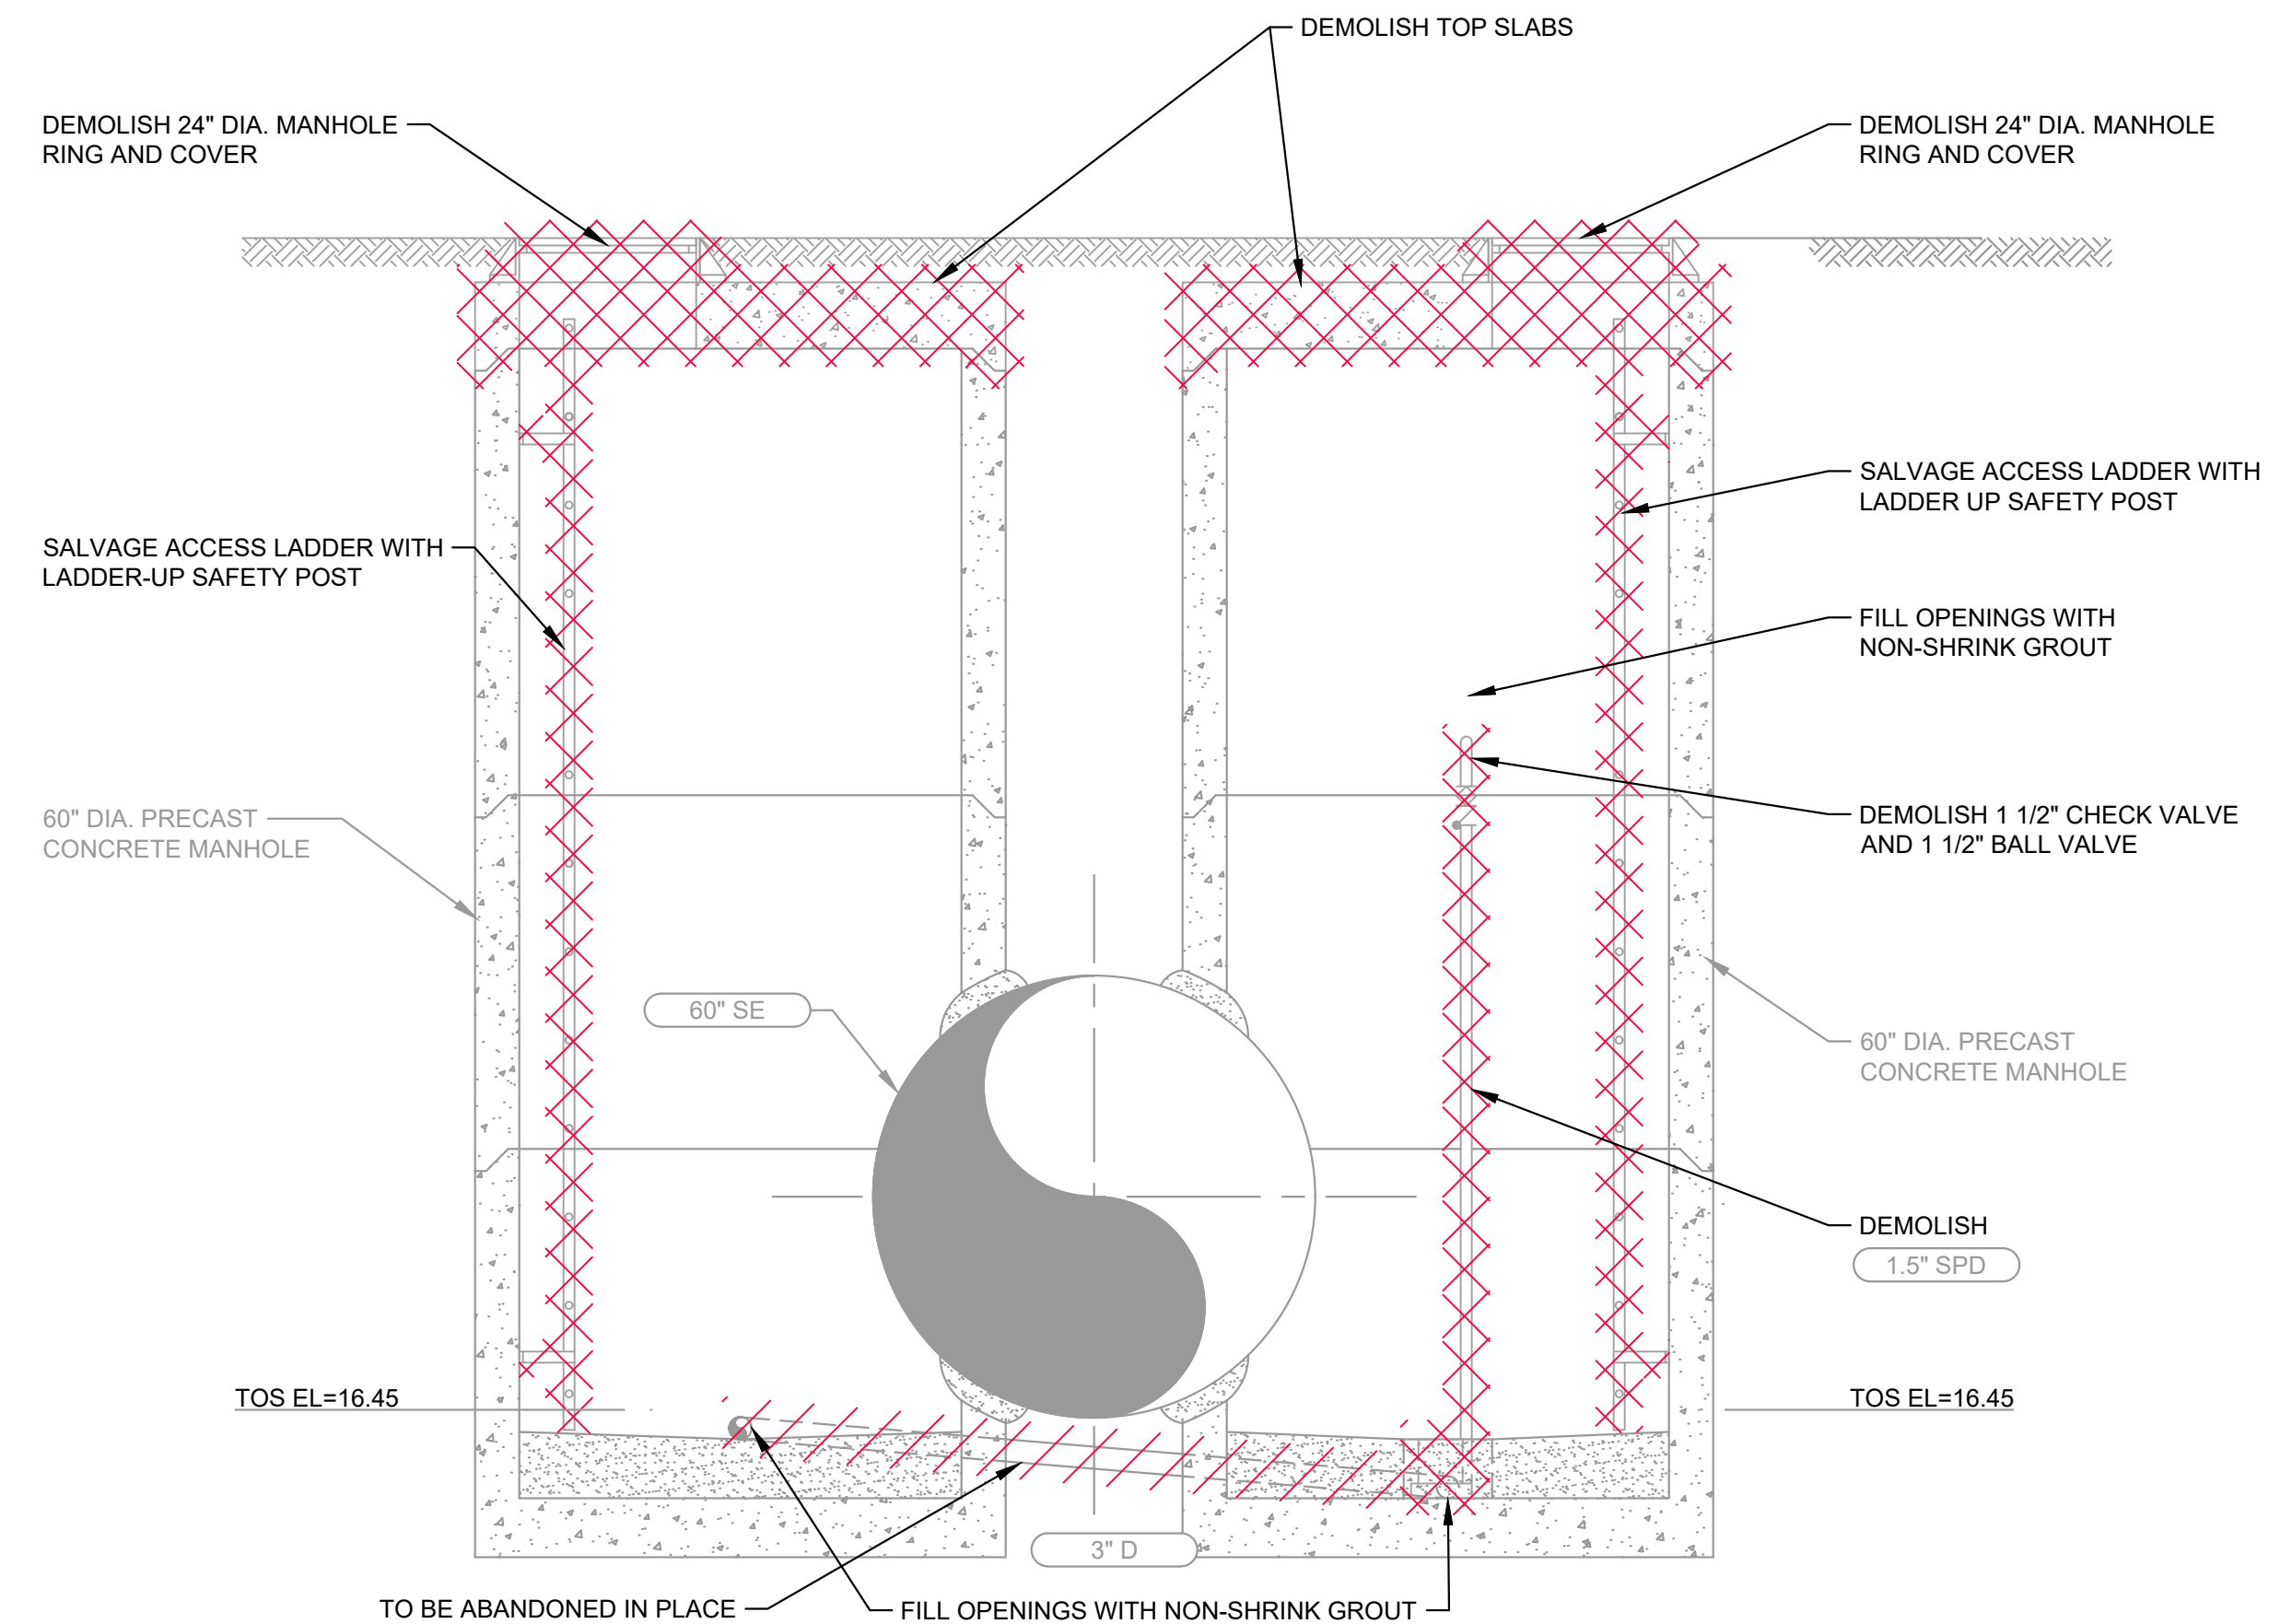


SECTION
SCALE: 1/2"=1'-0"

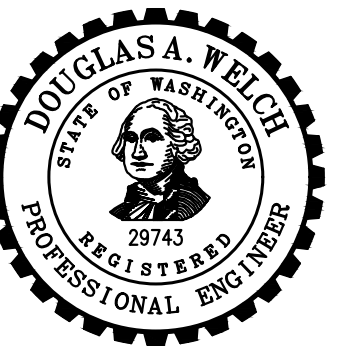

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

PRELIMINARY
NOT FOR
CONSTRUCTION

No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: XXX		
CHECKED BY: XXX		
DRAWN BY: XXX		
DESIGNER: XXX		
G & O JOB NO.: 21462		
FILE: M7_SCUM-PS-PLN.DWG		

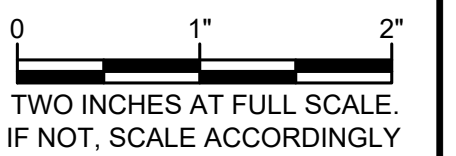


MECHANICAL
AREA 7

EXISTING EFFLUENT
FLOWMETER
MANHOLE DEMOLITION
PLAN


DRAWING: **M7-4** OF: **5**

APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

m:\PUYALLUP\21462\wpcp\3rd_secondary clarifier\01_design\Plan\set\Mechanical\M7_SCUM_PS-PLN.dwg, 1/3/2022 1:59 PM, CHARLEY REID

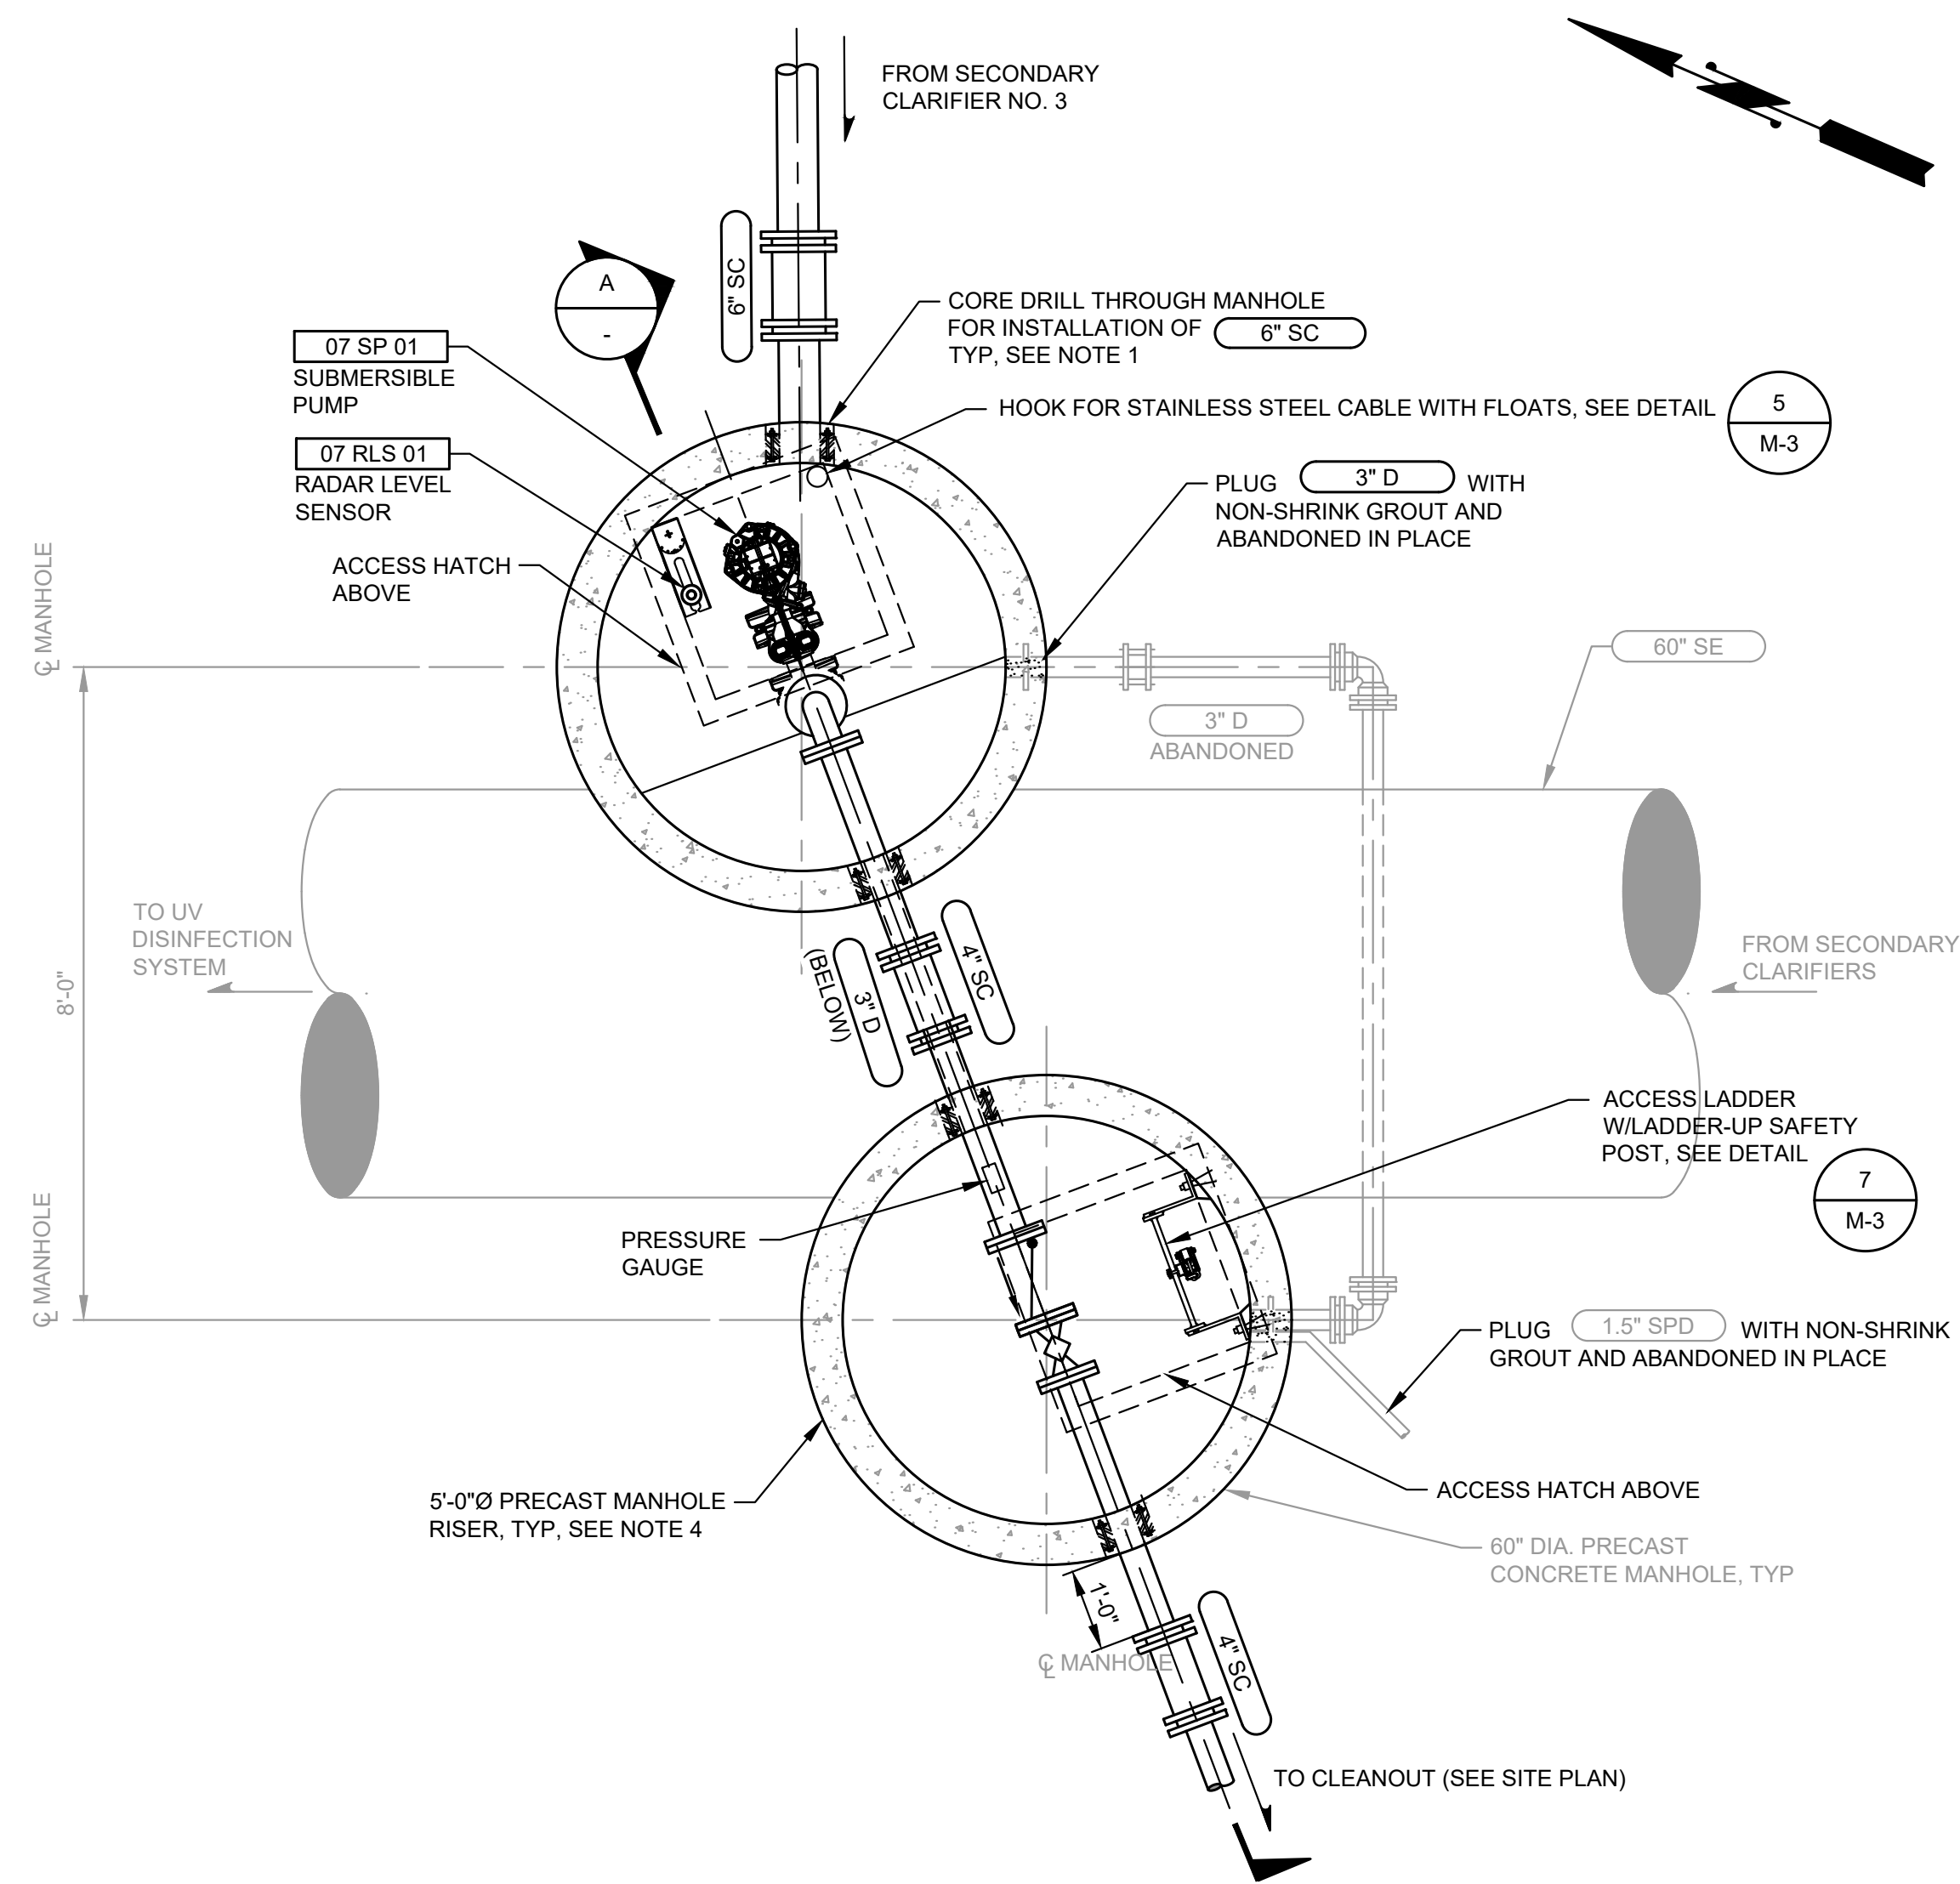


NEW SCUM PUMP STATION IN EXISTING MANHOLE
SCALE: 1/2"=1'-0"

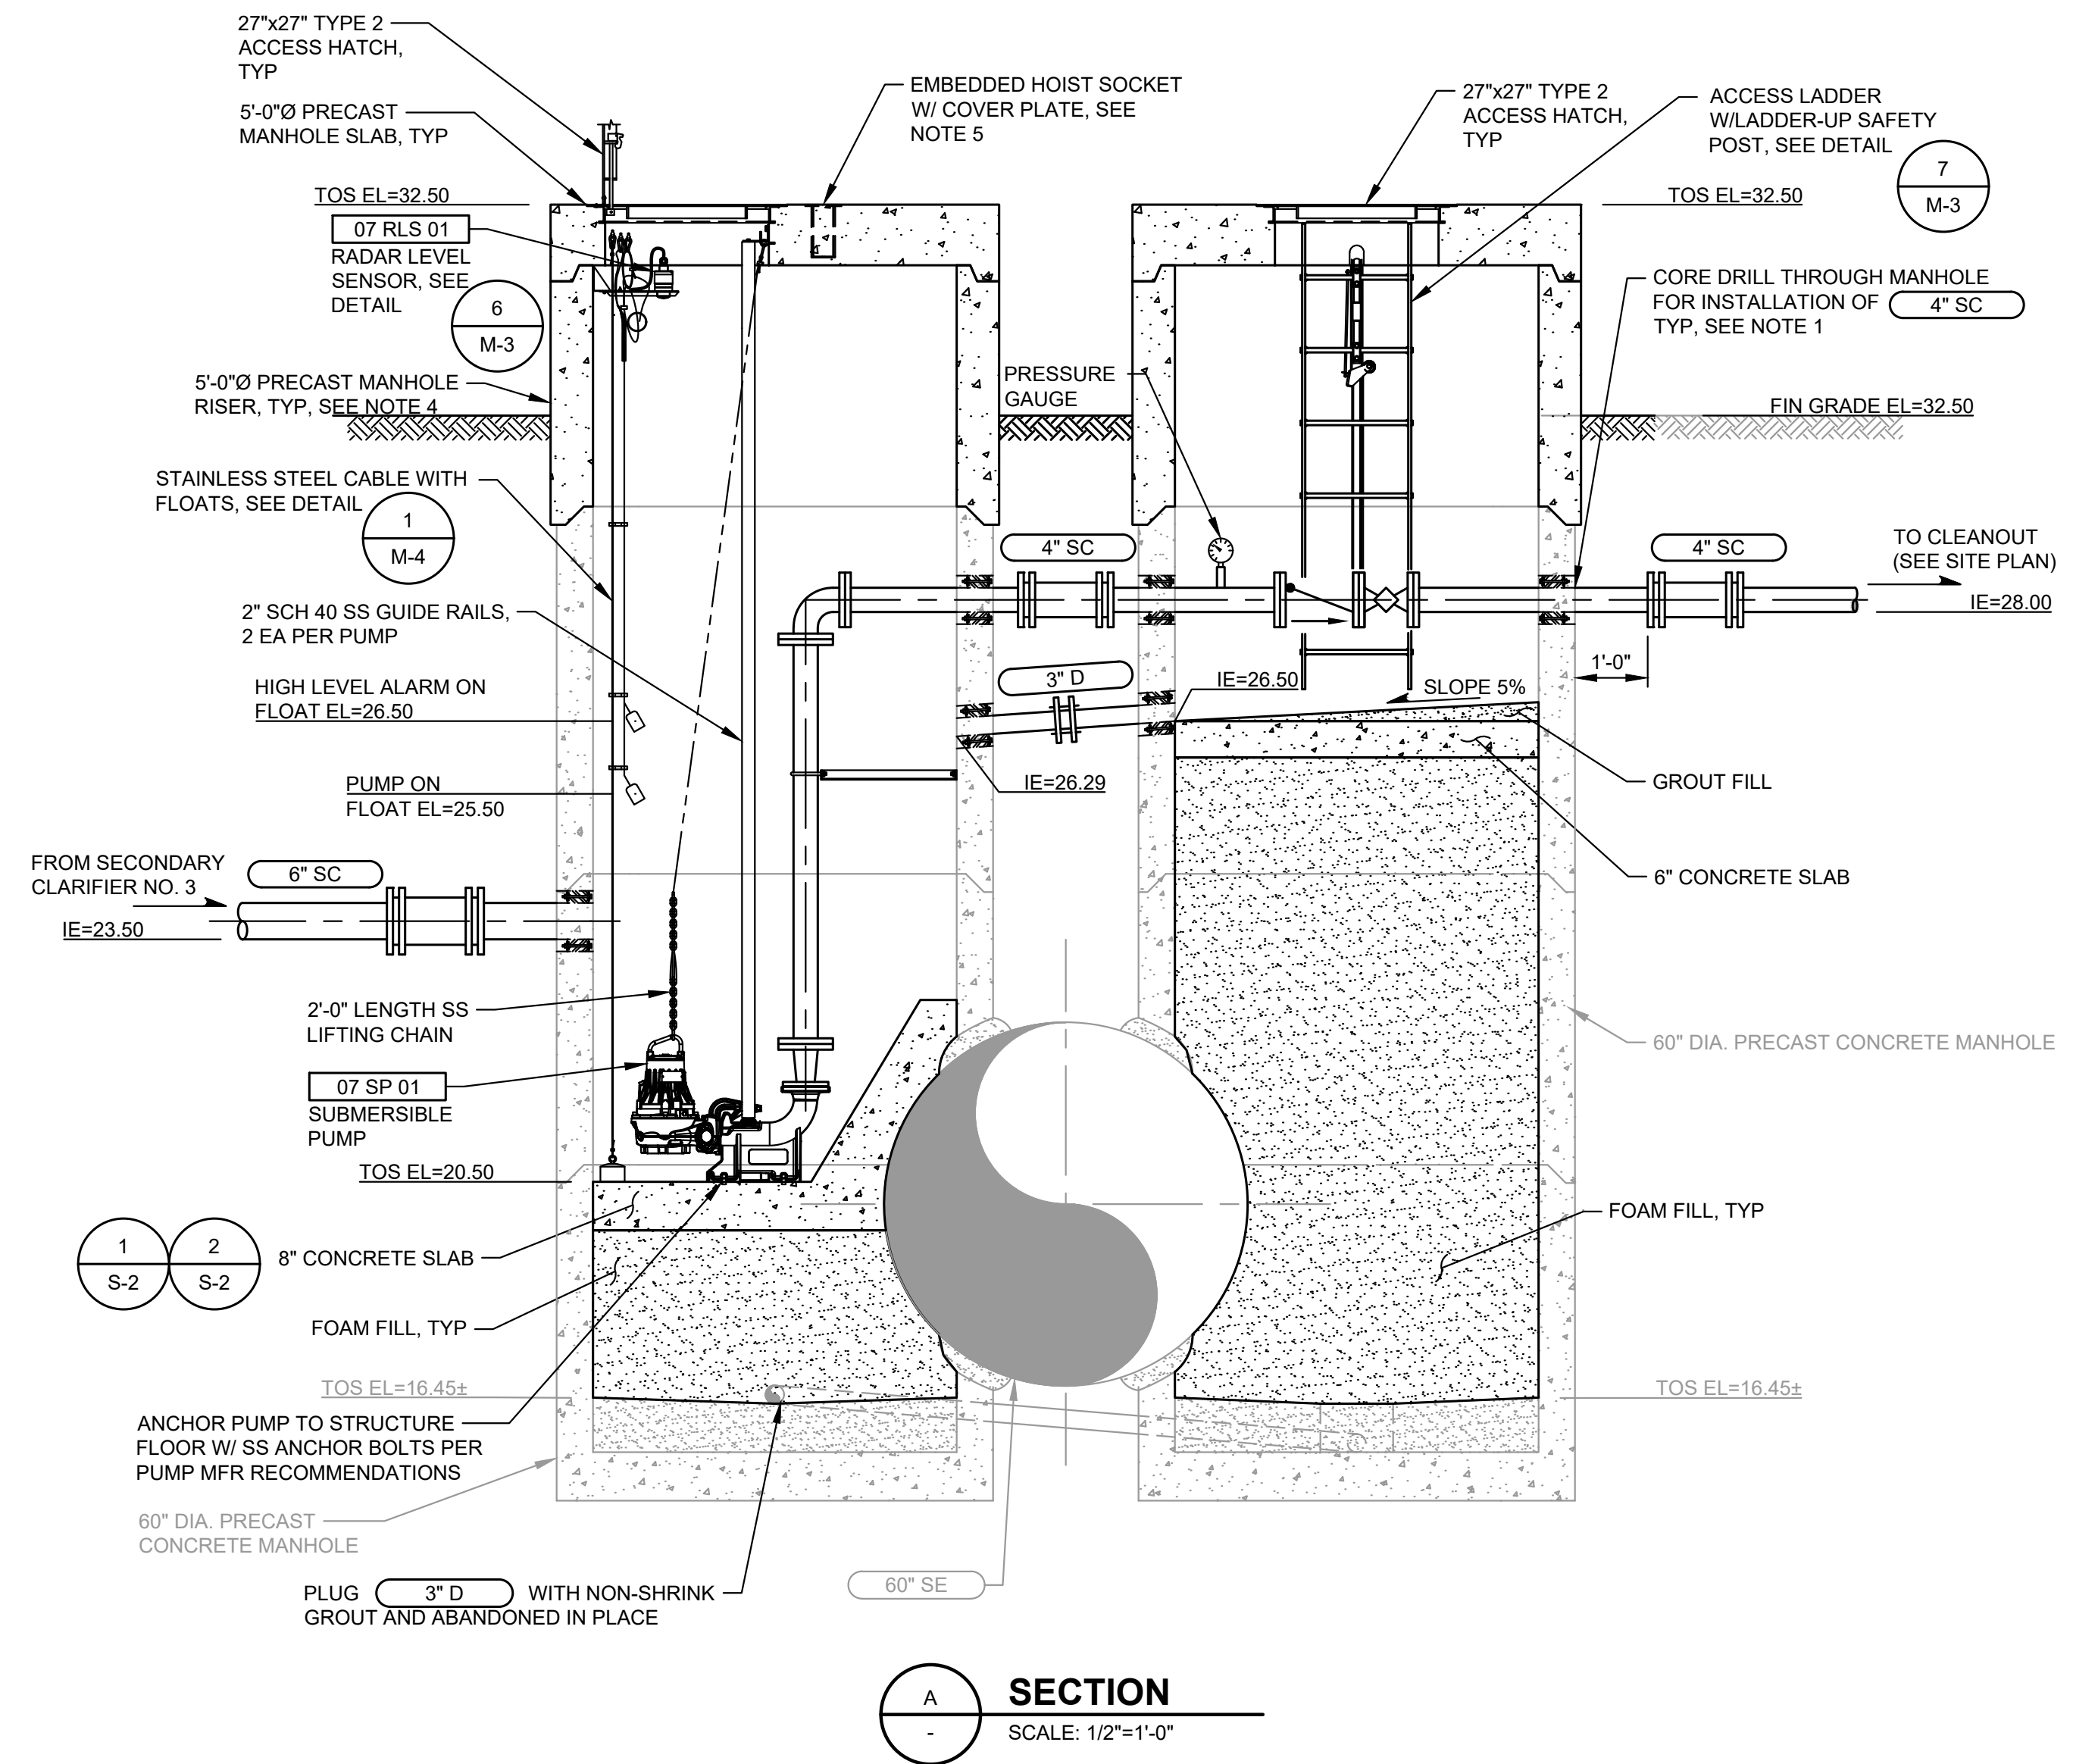

SECTION
SCALE: 1/2"=1'-0"

NOTES:


- FOR PIPING PENETRATIONS, SEE DETAIL M-2
- PIPES NOT SHOWN IN TRUE POSITION FOR CLARITY.
- PROVIDE PIPE SUPPORTS, SEE SPECIFICATION 15066.
- CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND ELEVATIONS PRIOR TO ORDERING RISE BARREL AND EQUIPMENT.
- COORDINATE LOCATION OF HOIST SOCKET WITH SPECIFIC PUMP SELECTED FOR PROJECT. HOIST SHALL BE LOCATED SUCH THAT HOOK IS DIRECTLY CENTERED ON THE LIFTING POINT OF THE PUMP.

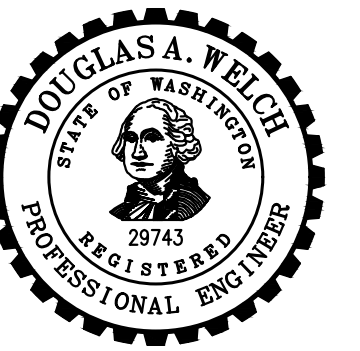

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: XXX		
CHECKED BY: XXX		
DRAWN BY: XXX		
DESIGNER: XXX		
G & O JOB NO.: 21462		
FILE: M7_SCUM-PS-PLN.DWG		


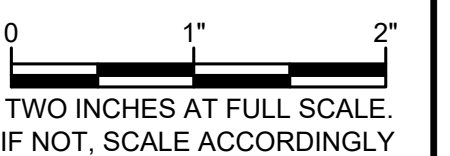


**MECHANICAL
AREA 7**

**SECONDARY
CLARIFIER NO. 3
SCUM PUMP STATION**


DRAWING: **M7-5** OF: **5**

APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

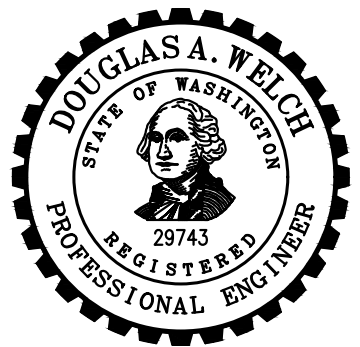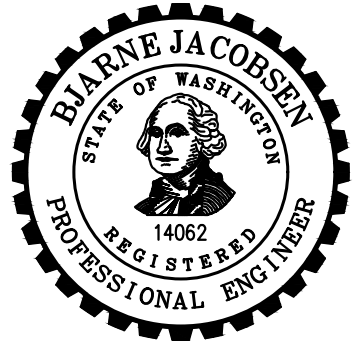


**PRELIMINARY
 NOT FOR
 CONSTRUCTION**

No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: XXX		
CHECKED BY: XXX		
DRAWN BY: XXX		
DESIGNER: XXX		
G & O JOB NO.: 21462		
FILE: M8_EFM-PLN-SEC.DWG		




**MECHANICAL
 AREA 8**

**EFFLUENT FLOW
 METER PLAN AND
 SECTION**

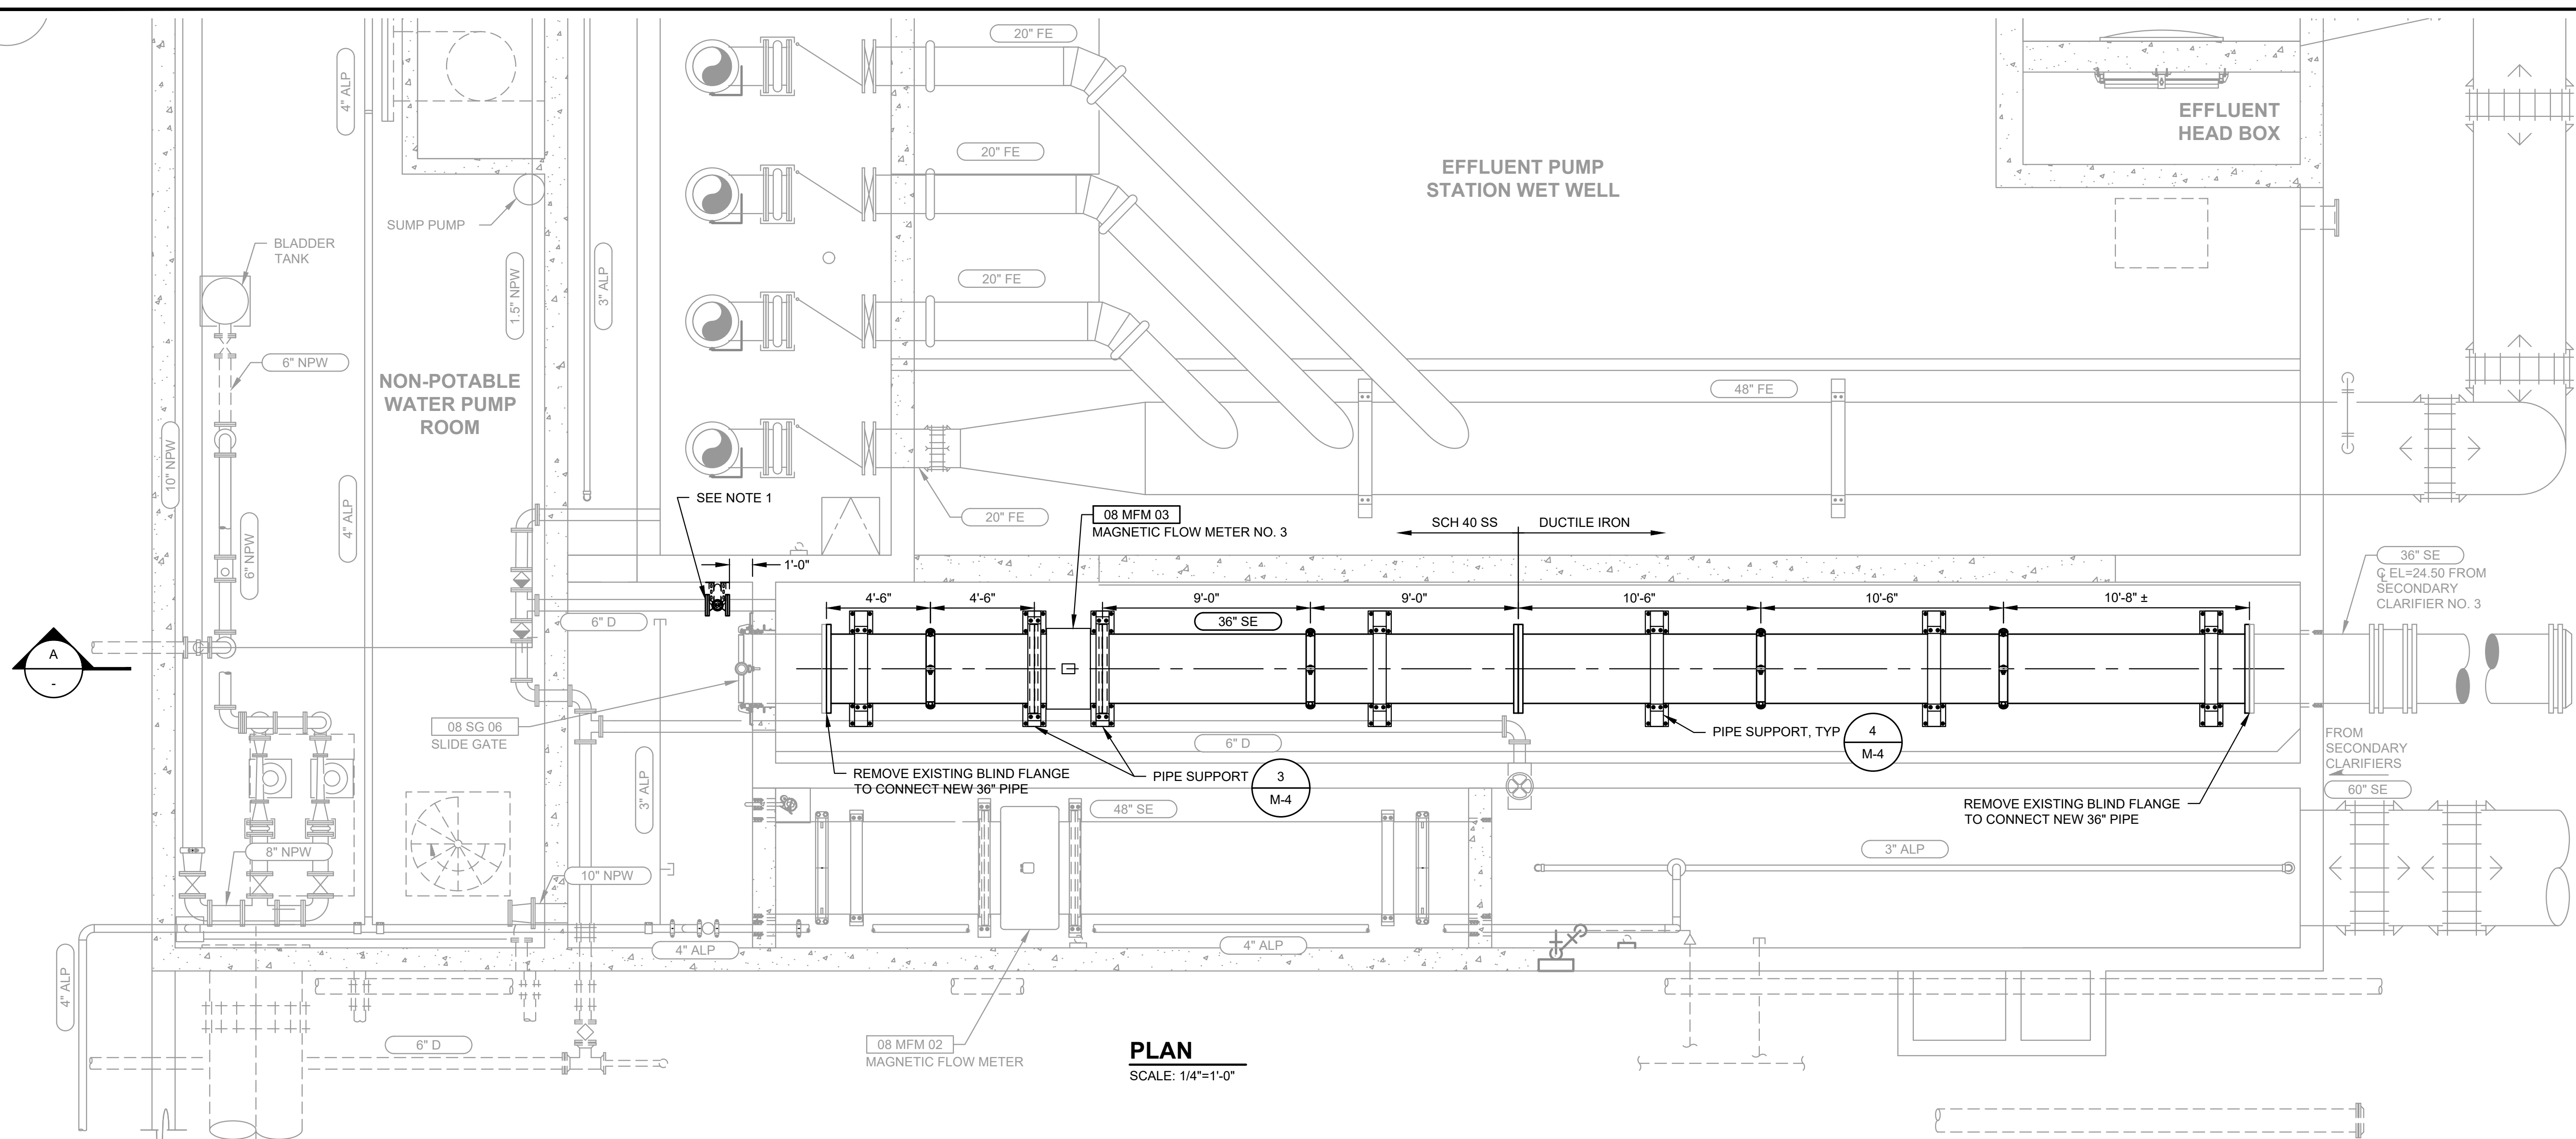

PLAN
 SCALE: 1/4"=1'-0"

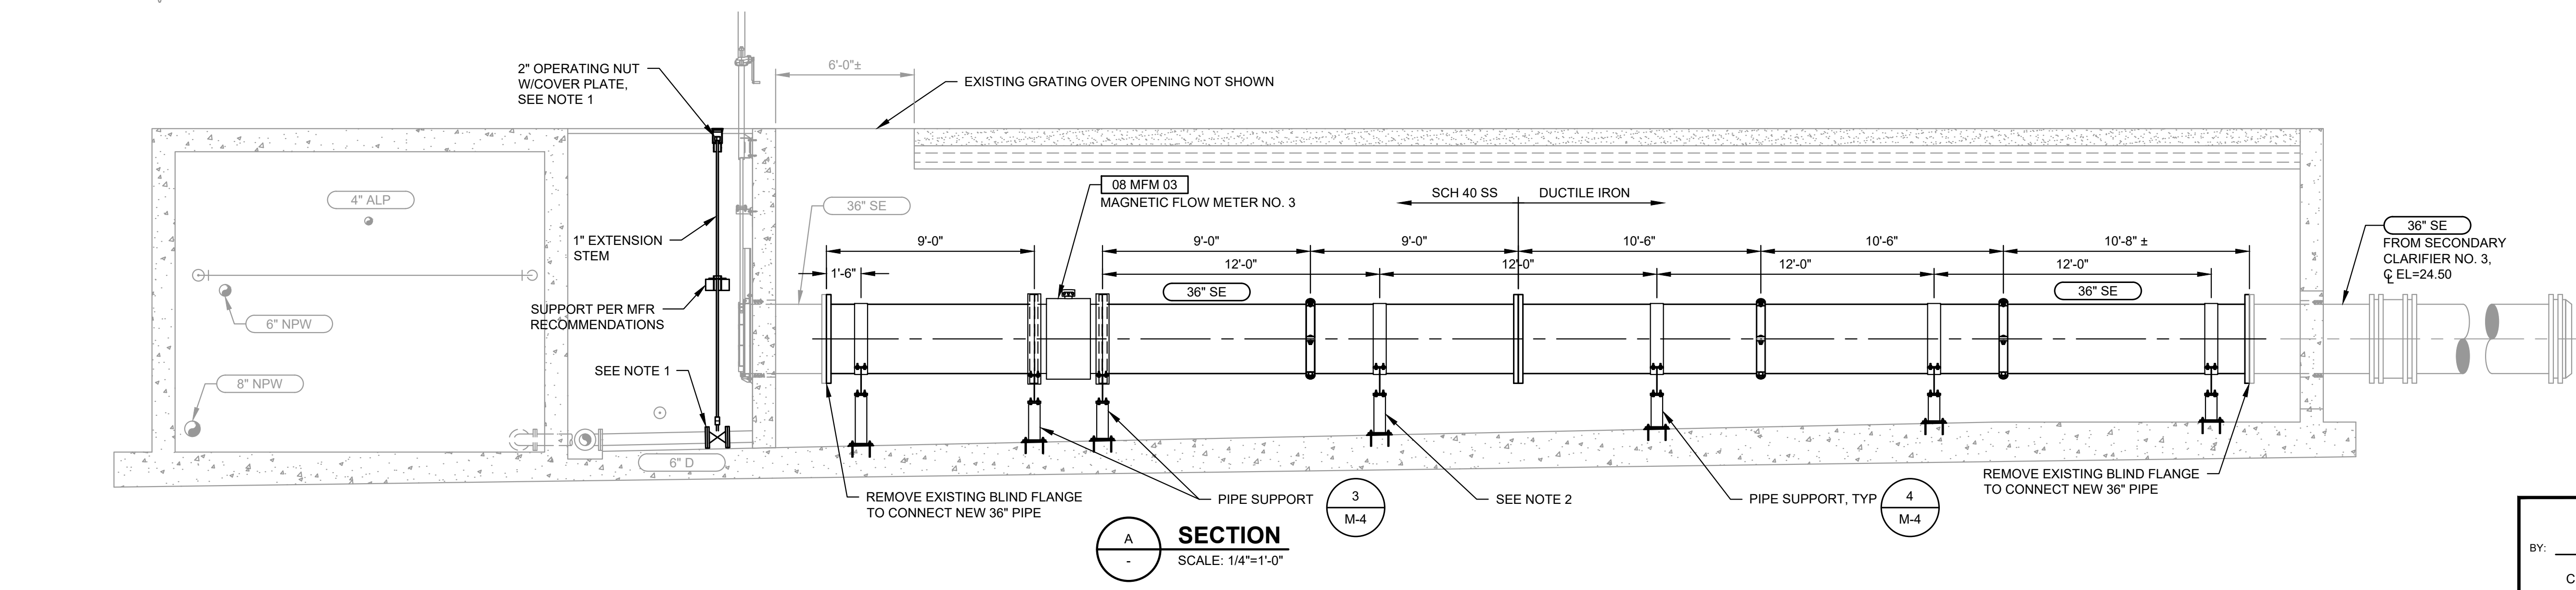

SECTION
 SCALE: 1/4"=1'-0"

- NOTES:**
- CUT 6" PIPE AND INSTALL NEW 6" PLUG VALVE WITH EXTENDED BONNET AND 2-INCH ACTUATOR NUT. PROVIDE SUPPORTS IN ACCORDANCE WITH MANUFACTURER RECOMMENDATIONS. PROVIDE 4-INCH DIAMETER BANDED OPENING IN EXISTING ALUMINUM GRATING WITH SOLID COVER PLATE. OPENING TO BE CENTERED ON VALVE ACTUATOR NUT.
 - CONTRACTOR SHALL VERIFY SLAB ELEVATION AT EACH SUPPORT LOCATION PRIOR TO FABRICATING SUPPORTS.

APPROVED

BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP

APPROVED
 DATE: _____
 EXPIRATION
 DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans.

Field conditions may dictate changes to these plans as determined by the City Engineer.

M:\PUYALLUP\21462 WPCP 3rd Secondary Clarifier\01 Design\Plan\Mechanical\M8_EFM-PLN-SEC.dwg, 1/3/2022 2:07 PM, CHARLEY REID

PROJECT DATA

- CODES:**
 IBC 2018 INTERNATIONAL BUILDING CODE
 IMC 2018 INTERNATIONAL MECHANICAL CODE
 IFC 2018 INTERNATIONAL FIRE CODE
 UPC 2018 UNIFORM PLUMBING CODE
 WSEC 2018 WASHINGTON STATE ENERGY CODE
 NFPA 2020 STANDARD FOR FIRE PROTECTION IN WASTEWATER TREATMENT AND COLLECTION FACILITIES

PROJECT DESCRIPTION:
 ADDITION OF A METAL STUD FRAMED WALL AND DOOR TO SEPARATE THE MOTOR CONTROL CENTER AND THE RAS/WAS PUMP ROOM.

IBC OCCUPANCY:
 U - RAS/WAS PUMP STATION




IBC TYPE OF CONSTRUCTION:
 TYPE - V.B.


IBC FIRE RESISTIVE REQUIREMENTS:
 BEARING WALLS - 0 HOURS
 NONBEARING WALLS - 0 HOURS
 FLOOR ASSEMBLIES - 0 HOURS
 ROOF ASSEMBLIES - 0 HOURS
 ALL OTHER CONSTRUCTIONS - NON-RATED
 (ALL FIRE SEPARATION DISTANCES ≥ 30 FEET.)

NFPA 820 REQUIREMENTS:
 THE RAS/WAS PUMP ROOM SHALL BE UNCLASSIFIED PER NEC AREA ELECTRICAL CLASSIFICATION REQUIREMENTS WHEN VENTILATED AT 6 AIR CHANGES PER HOUR IN ACCORDANCE WITH NFPA 820.


- GENERAL NOTES:**
- ALL DIMENSIONS ARE TO FACE OF FRAMING AND CMU WALL UNLESS NOTED OTHERWISE.
 - NOT ALL WALL PENETRATION, MAY BE SHOWN. COORDINATE SIZE AND LOCATIONS WITH MECHANICAL, PLUMBING, ELECTRICAL AND HVAC DRAWINGS.
 - INSULATION SHALL BE INSTALLED SUCH THAT IDENTIFICATION MARKINGS ARE READILY OBSERVABLE DURING INSPECTION.

WALL TYPES & LEGEND

-  EXISTING WALL
-  NEW 2x4 METAL STUD @ 16" OC TO CEILING W/ 1/2" GWB EA SIDE; PAINT TO SPECIFICATIONS
-  DOOR NUMBER, SEE DOOR SCHEDULE THIS SHEET

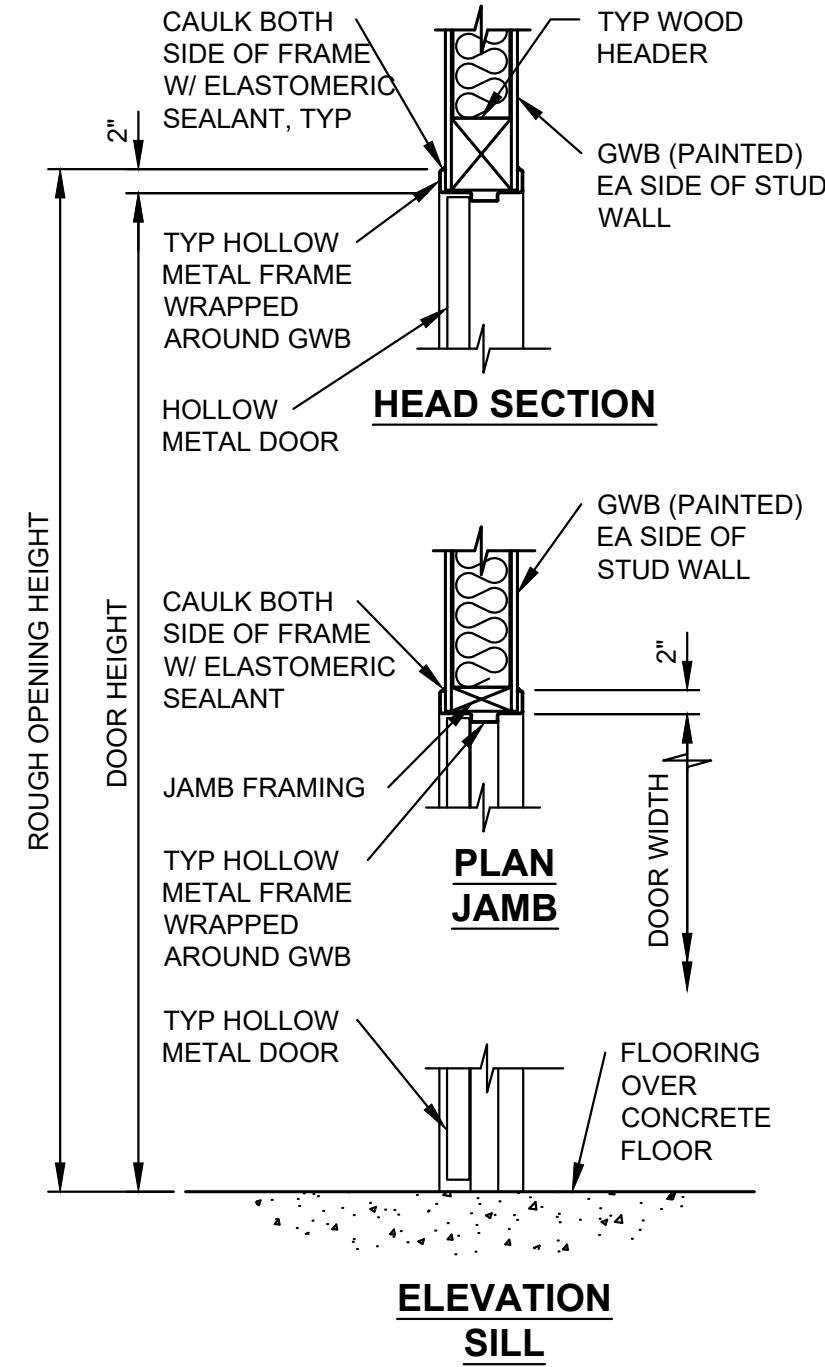


DEMOLISH EXISTING SKYLIGHT ABOVE STAIR; ROOF CURB TO REMAIN

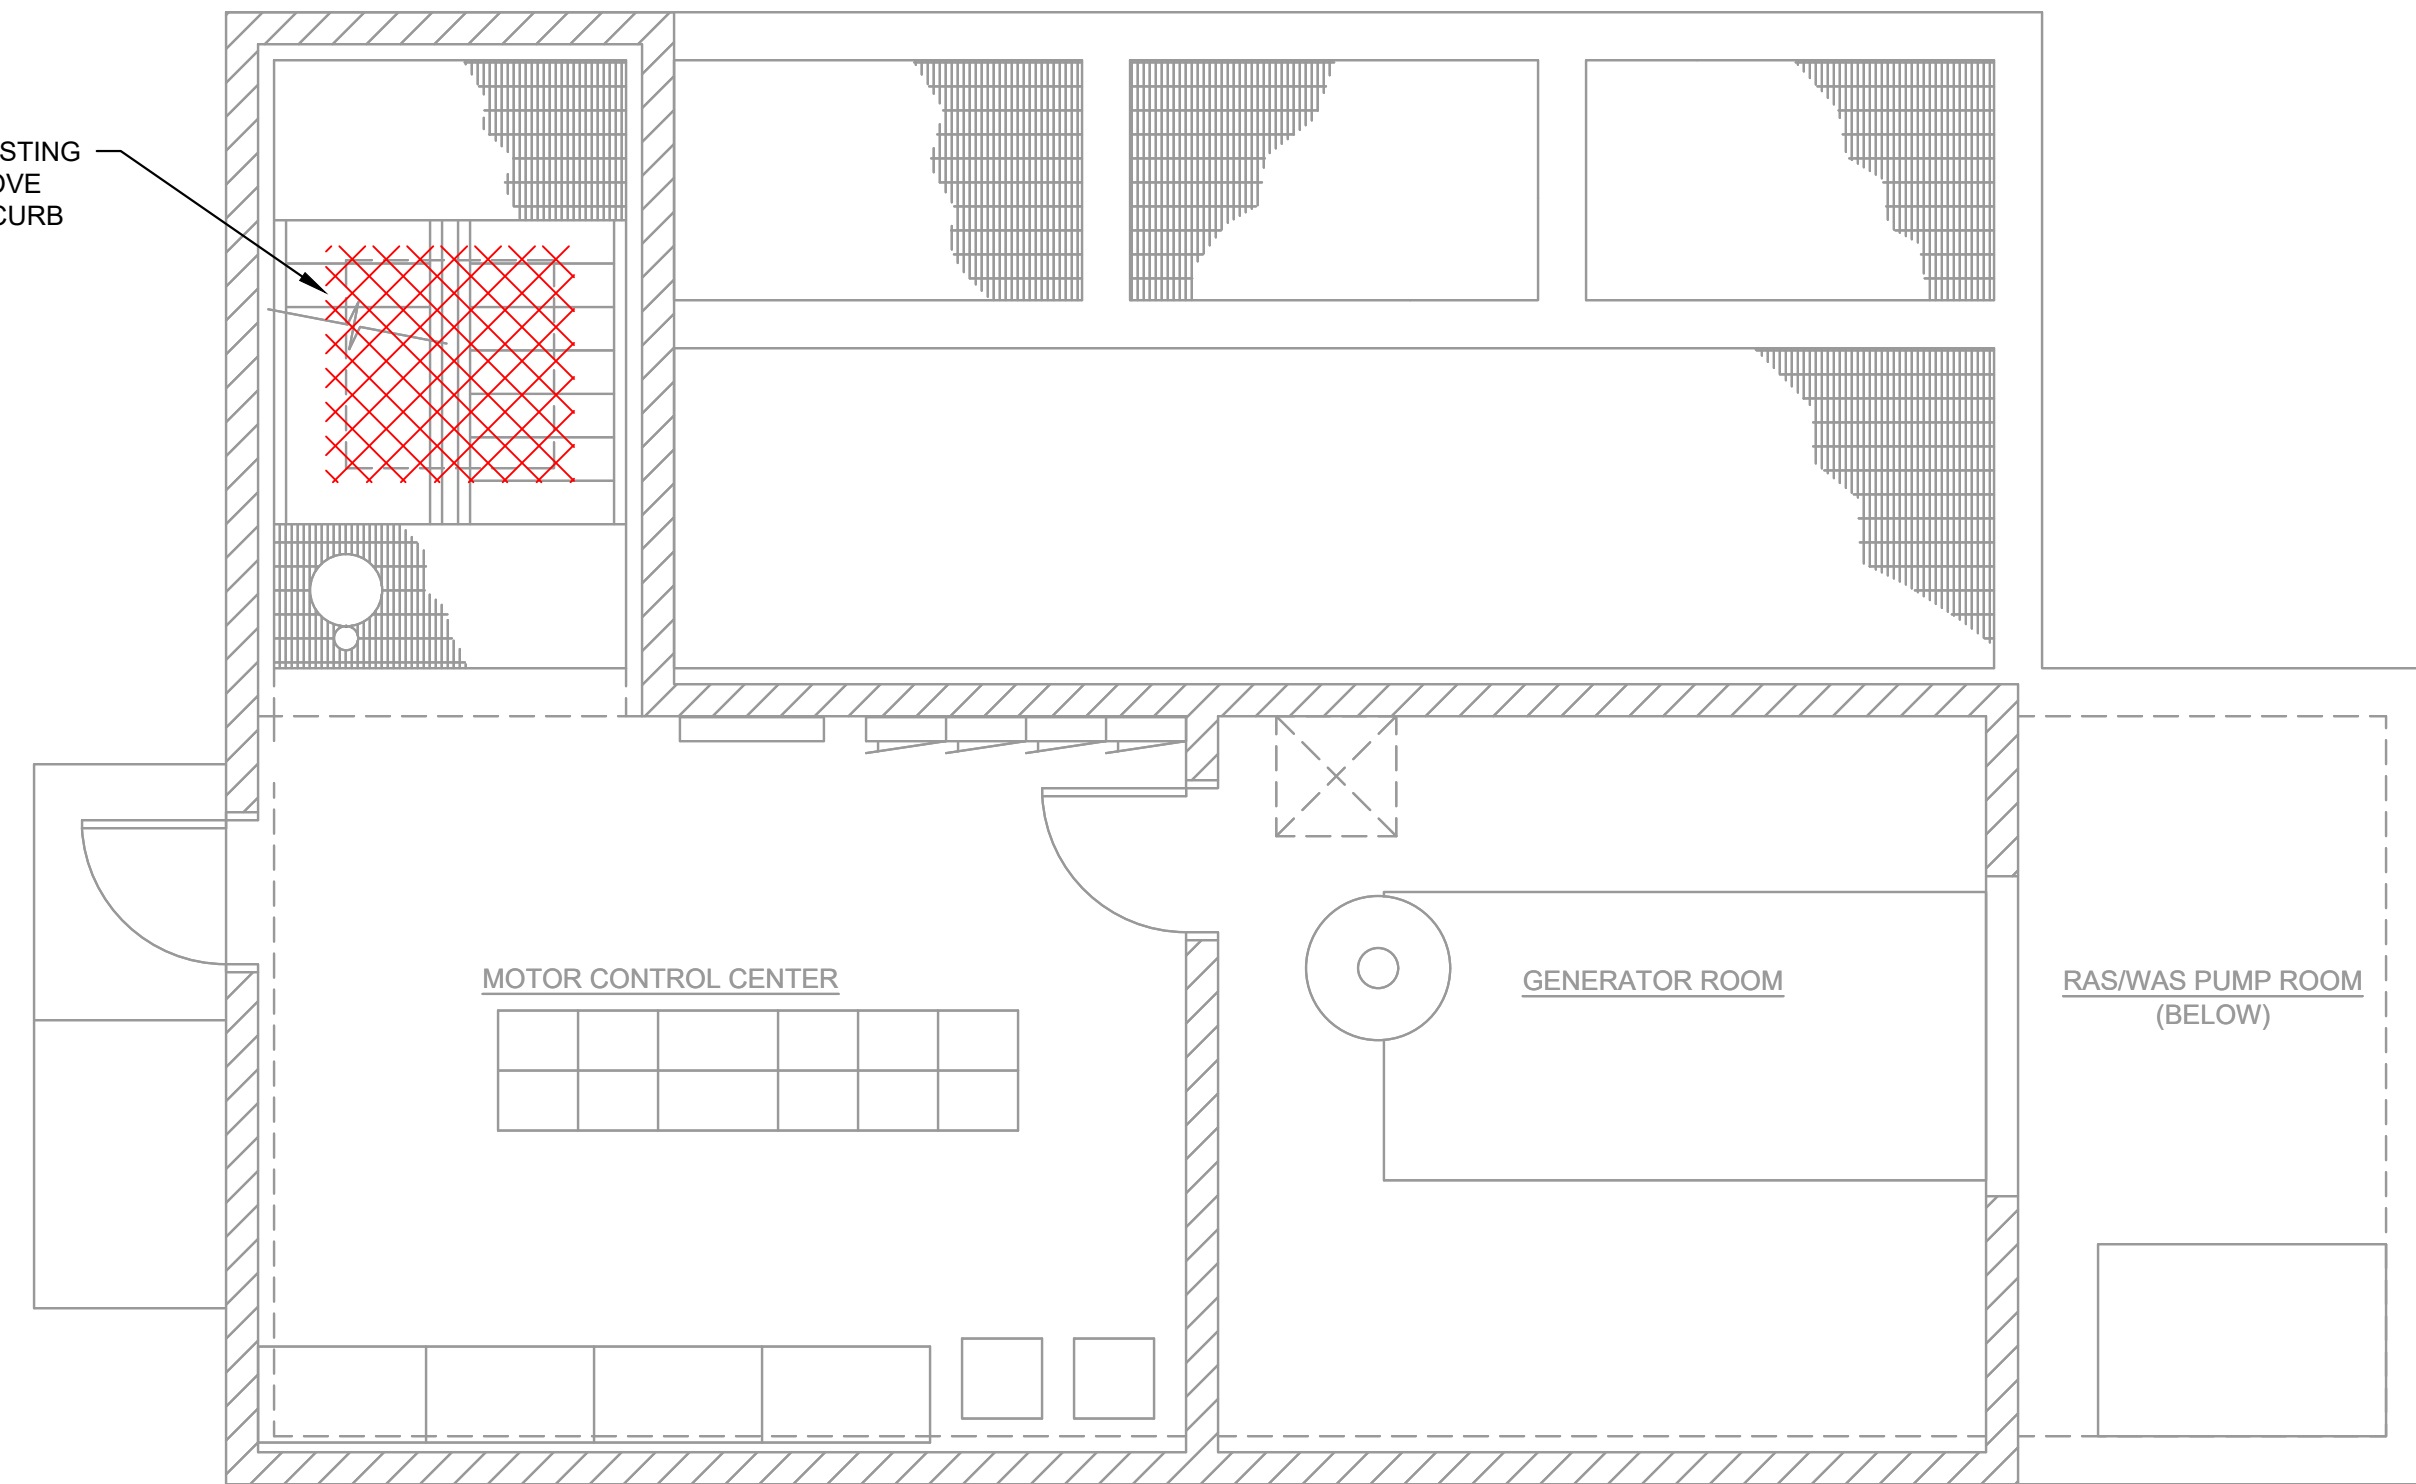


DEMO PLAN
 SCALE: 1/4"=1'-0"

NEW HVAC EQUIPMENT, TYP; SEE H-SHEETS

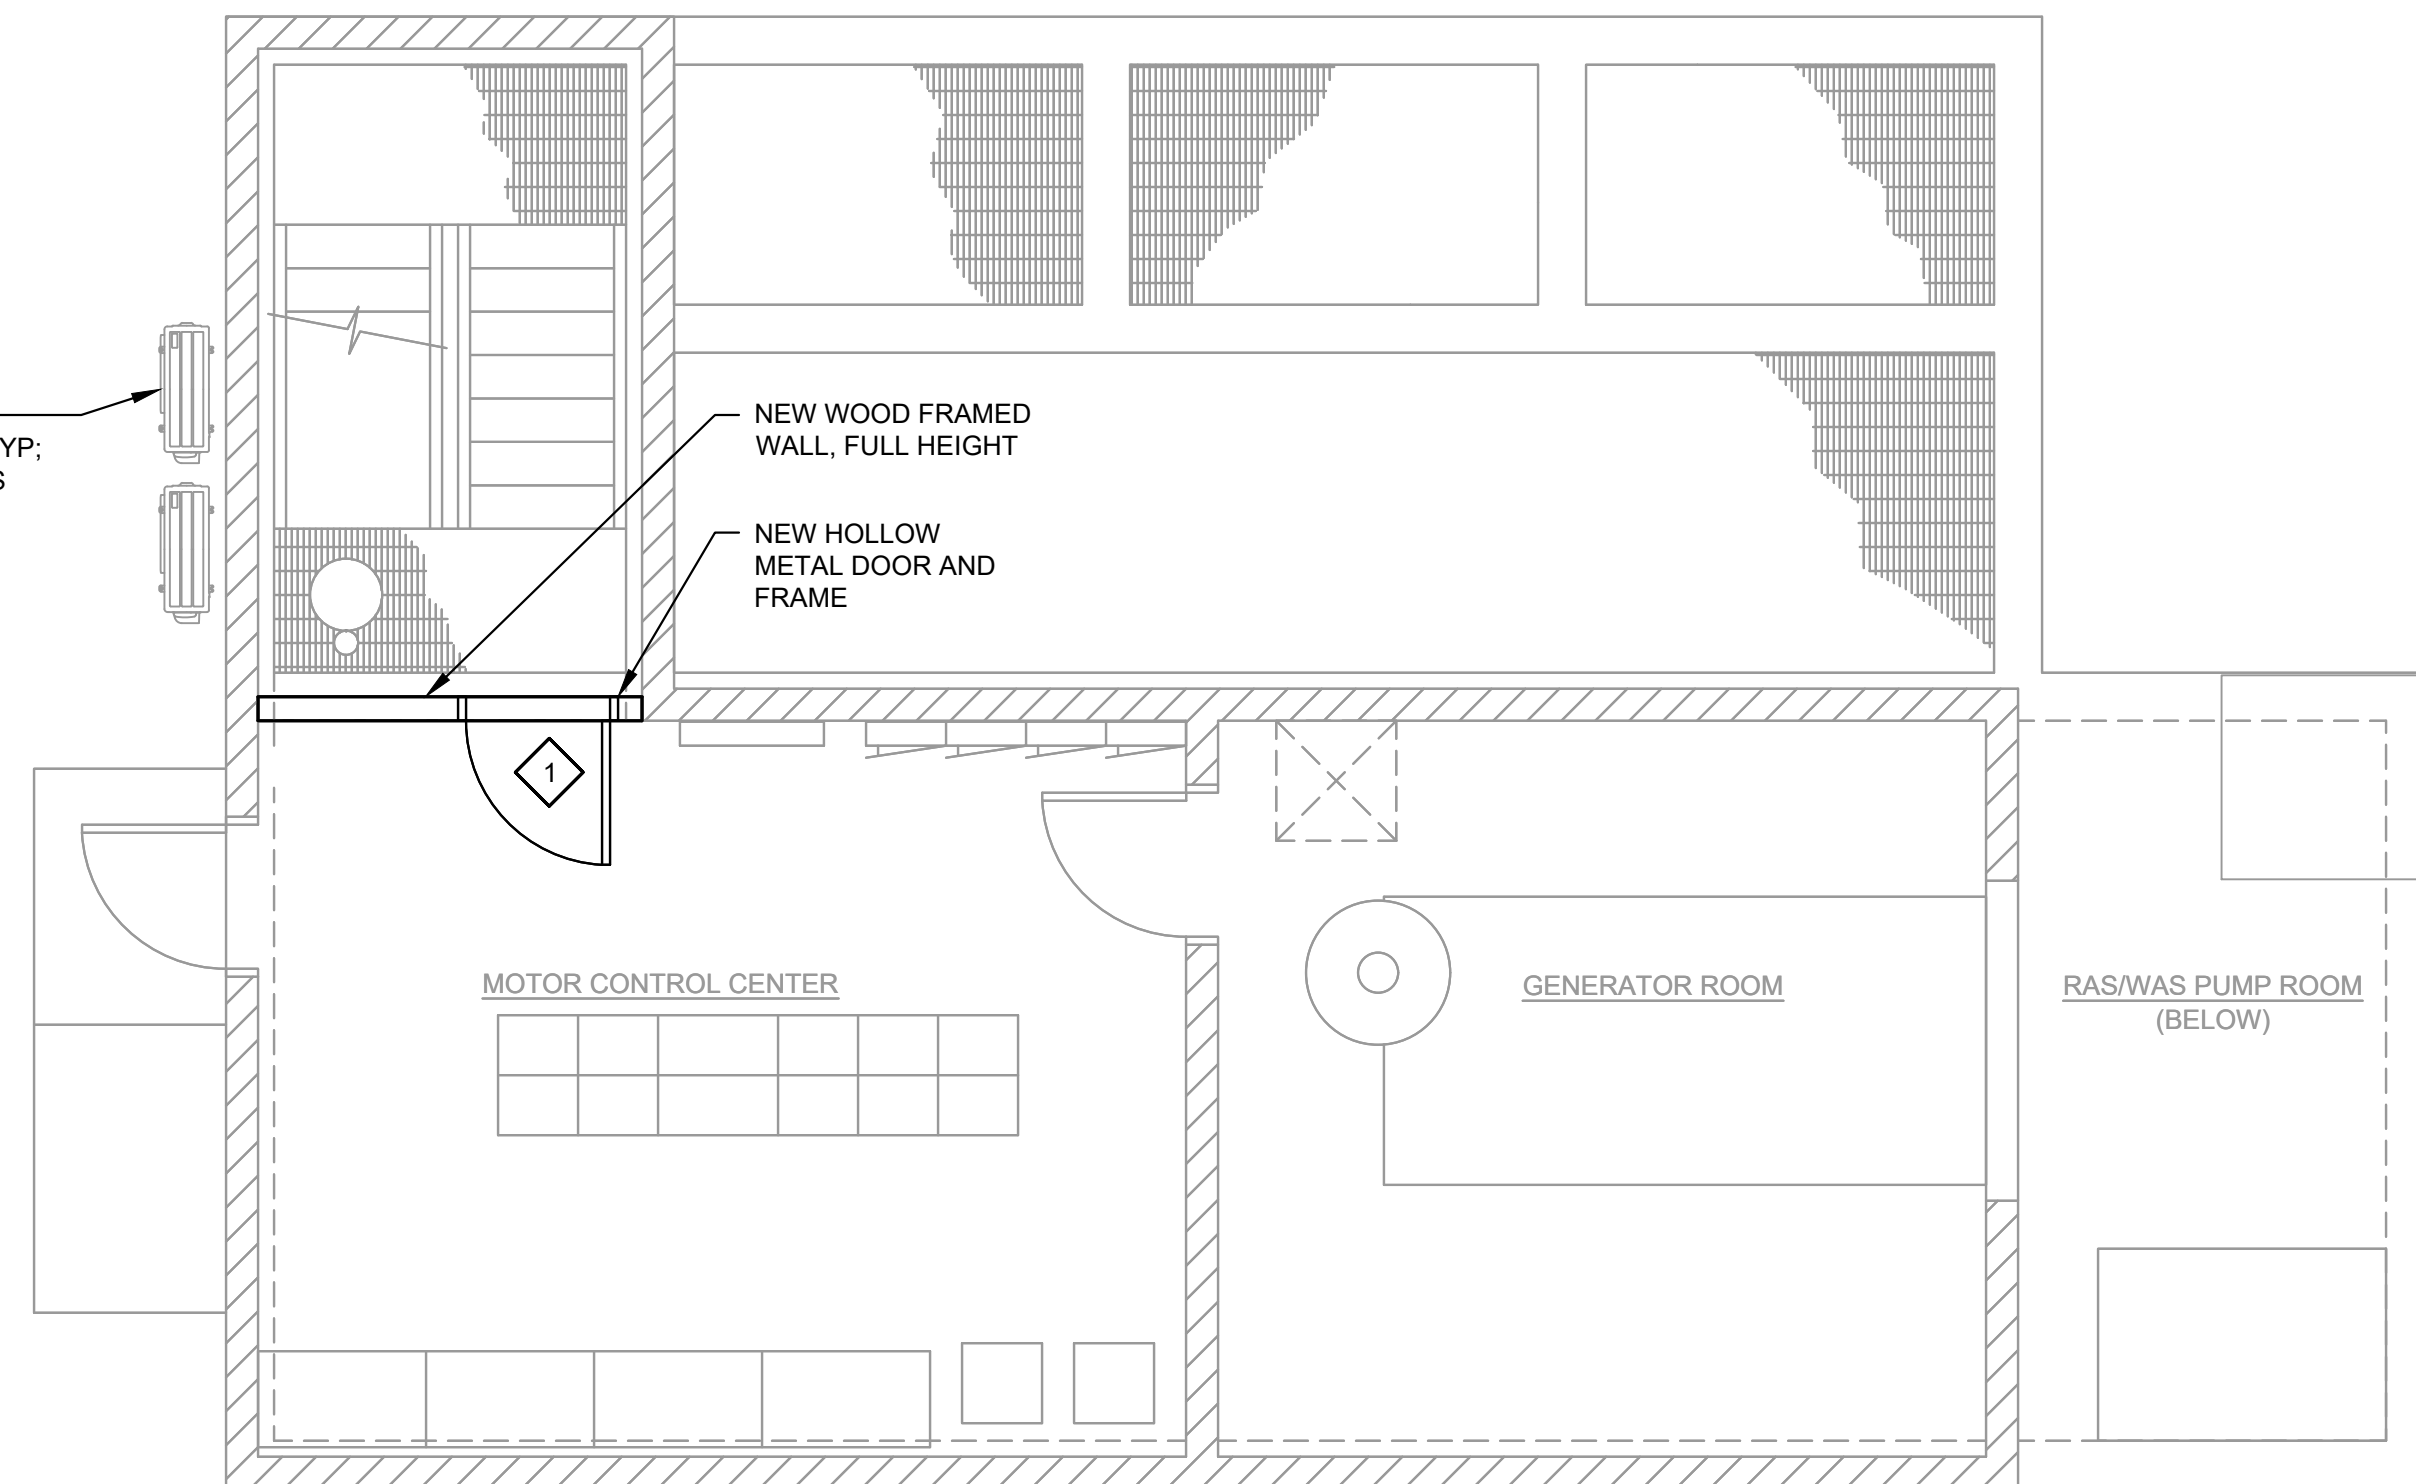

PLAN
 SCALE: 1/4"=1'-0"

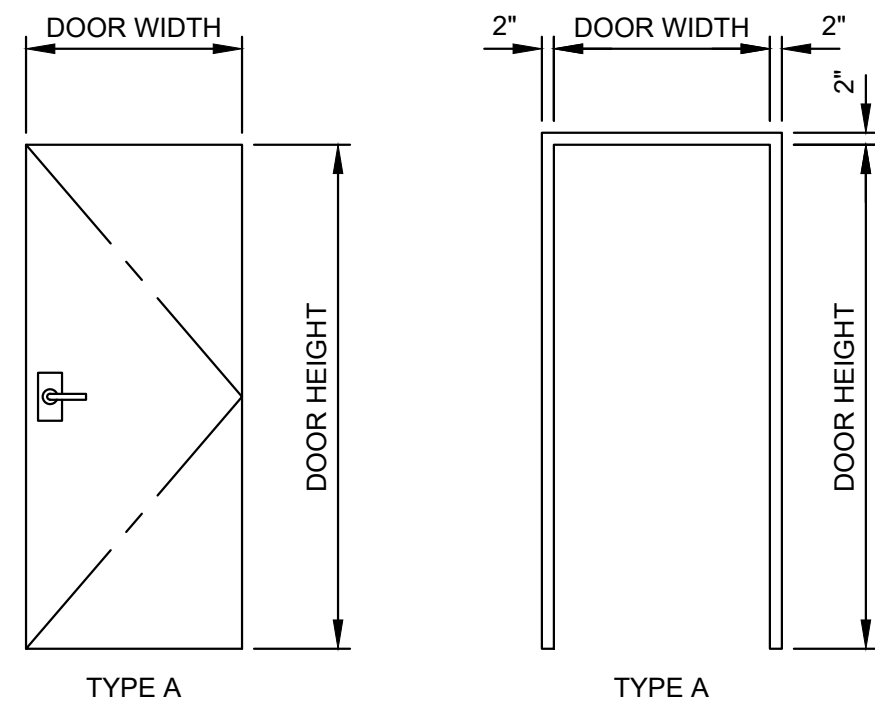


DOOR TYPE SCALE: NTS
DOOR FRAME TYPE SCALE: NTS

DOOR SCHEDULE							
NO.	MATERIAL & TYPE	DOOR SIZE: WIDTH x HEIGHT x THICKNESS	DOOR TYPE	FRAME TYPE	MAX. U-FACTOR	FINISH	HARDWARE GROUP
1	HOLLOW METAL INSULATED	3'-0" x 7'-0" x 1 3/4"	A	A	0.34	PAINT	1

APPROVED
 BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP
 APPROVED DATE: _____
 EXPIRATION DATE: _____
 NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
 The City will not be responsible for errors and/or omissions on these plans.
 Field conditions may dictate changes to these plans as determined by the City Engineer.

Gray & Osborne, Inc.
 CONSULTING ENGINEERS
 1130 RAINIER AVENUE SOUTH, SUITE 300
 SEATTLE, WASHINGTON 98144
 (206) 284-0860

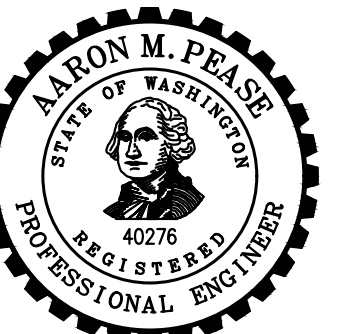

CITY OF PUYALLUP
 WATER POLLUTION CONTROL PLANT THIRD SECONDARY CLARIFIER
 CIP NO. 20-018
 1602 18TH ST NW,
 PUYALLUP, WA 98371

PRELIMINARY NOT FOR CONSTRUCTION

No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: AMP		
CHECKED BY: DAW		
DRAWN BY: ASD		
DESIGNER: ASD		
G & O JOB NO.: 21462		
FILE: A_RASWAS.DWG		

0 1" 2"
 TWO INCHES AT FULL SCALE.
 IF NOT, SCALE ACCORDINGLY

ARCHITECTURAL AREA 6

RAS/WAS PUMP STATION NOTES, DETAILS, AND PLANS

DRAWING: **A6-1** OF: **1**

HVAC DESIGN CRITERIA

EXISTING CONDITIONS

MOTOR CONTROL CENTER AND RAS/WAS PUMP ROOM:

COOLING: VENTILATION
 SYSTEM: ROOF SUPPLY FAN [06 EX 01] AND ROOF EXHAUST FAN [06 EX 03]
 CAPACITY: 3,000 CFM
 CONTROLS: REMOTE THERMOSTAT W/ 80 °F SETPOINT

HEATING: NONE

GENERATOR ROOM:

COOLING: VENTILATION
 SYSTEM: ROOF EXHAUST FAN [06 EX 02]
 CAPACITY: 600 CFM
 CONTROLS: REMOTE THERMOSTAT W/ 90 °F SETPOINT

HEATING: NONE

DESIGN TEMPERATURES

THE NEAREST DEFINED WSEC APPENDIX C LOCATION IS PUYALLUP.

WINTER AMBIENT TEMP: 19 °F
 SUMMER AMBIENT TEMP: 86 °F
 INTERIOR HEATING SETPOINT: 45 °F
 INTERIOR COOLING SETPOINT: 95 °F

VENTILATION

RAS/WAS PUMP ROOM:

THE RAS/WAS PUMP ROOM WILL BE VENTILATED WITH BOTH SUPPLY AND EXHAUST AT A RATE OF >6 ACH TO DECLASSIFY THE SPACE PER NFPA 820. EXHAUST FLOW WILL BE INCREASED TO NEGATIVELY PRESSURIZE THE SPACE PER NFPA 820.

FLOOR AREA: 664 SF
 AVERAGE HEIGHT: 20.6 FT
 TOTAL VOLUME: 13,710 CUBIC FT
 REQ'D ACH: 6 ACH
 REQ'D AIRFLOW: 1,370 CFM

DESIGN SUPPLY: 1,500 CFM
 DESIGN EXHAUST: 1,600 CFM

MOTOR CONTROL CENTER:

NONE: THE MOTOR CONTROL CENTER IS CONSIDERED AN UNOCCUPIED EQUIPMENT SPACE.

GENERATOR ROOM:

NO NEW WORK

HEATING/COOLING

RAS/WAS PUMP ROOM:

REQ'D HEATING LOAD: 55.9 MBH
 TYPE: ELECTRIC RESISTANCE
 REQ'D CAPACITY: 16.1 KW

MOTOR CONTROL CENTER:

REQ'D HEATING LOAD: 7.4 MBH
 REQ'D COOLING LOAD: 25.7 MBH
 TYPE: TWO SPLIT HEAT PUMP AND FAN COIL SYSTEMS; EACH FOR 70% OF LOAD
 CAPACITY: 18.0 MBH

GENERATOR ROOM:

NO NEW WORK

CONTROL DESCRIPTION:

HEAT PUMP [06 HP 01] AND WALL MOUNTED FAN COIL [06 FC 01] PROVIDE HEATING AND COOLING FOR THE MOTOR CONTROL CENTER AND IS CONTROLLED BY THERMOSTAT [06 T 01].



HEAT PUMP [06 HP 02] AND WALL MOUNTED FAN COIL [06 FC 02] PROVIDE REDUNDANT HEATING AND COOLING FOR THE MOTOR CONTROL CENTER AND IS CONTROLLED BY THERMOSTAT [06 T 02].

ROOF SUPPLY FAN [06 SF 01] AND ROOF EXHAUST FAN [06 EF 01] PROVIDE CONTINUOUS VENTILATION TO DECLASSIFY THE RAS/WAS PUMP ROOM PER NFPA 820.

AIRFLOW SWITCHES [06 FS 01] AND [06 FS 02] MONITOR THE AIRFLOW WITHIN THE SUPPLY AND EXHAUST DUCTWORK OF THE RAS/WAS PUMP ROOM. EACH SWITCH SHALL BE SET TO ALARM IF THE AIRFLOW FALLS BELOW 1,370 CFM.

DUCT HEATER [06 HT 01] PROVIDE HEATING FOR FREEZE PROTECTION TO THE RAS/WAS PUMP ROOM AND IS CONTROLLED BY THERMOSTAT [06 T 03].

HVAC SYMBOLS

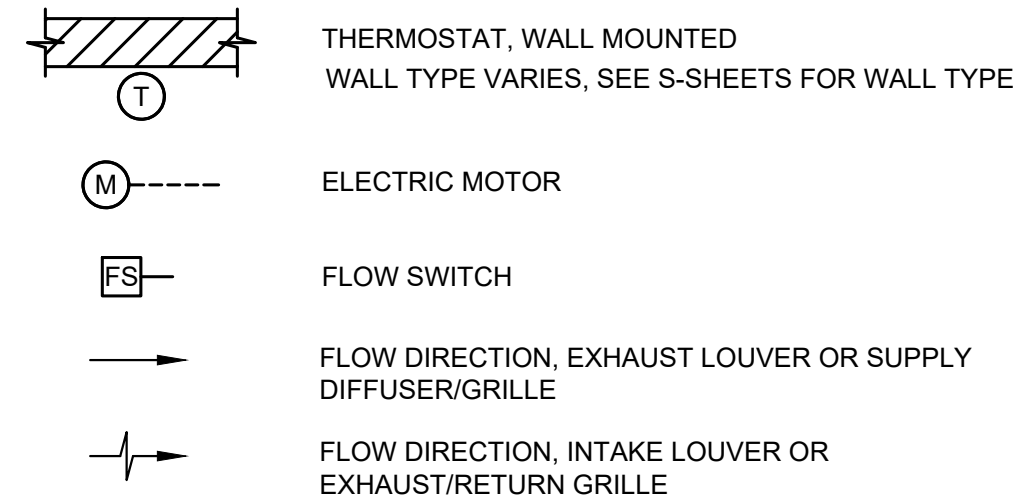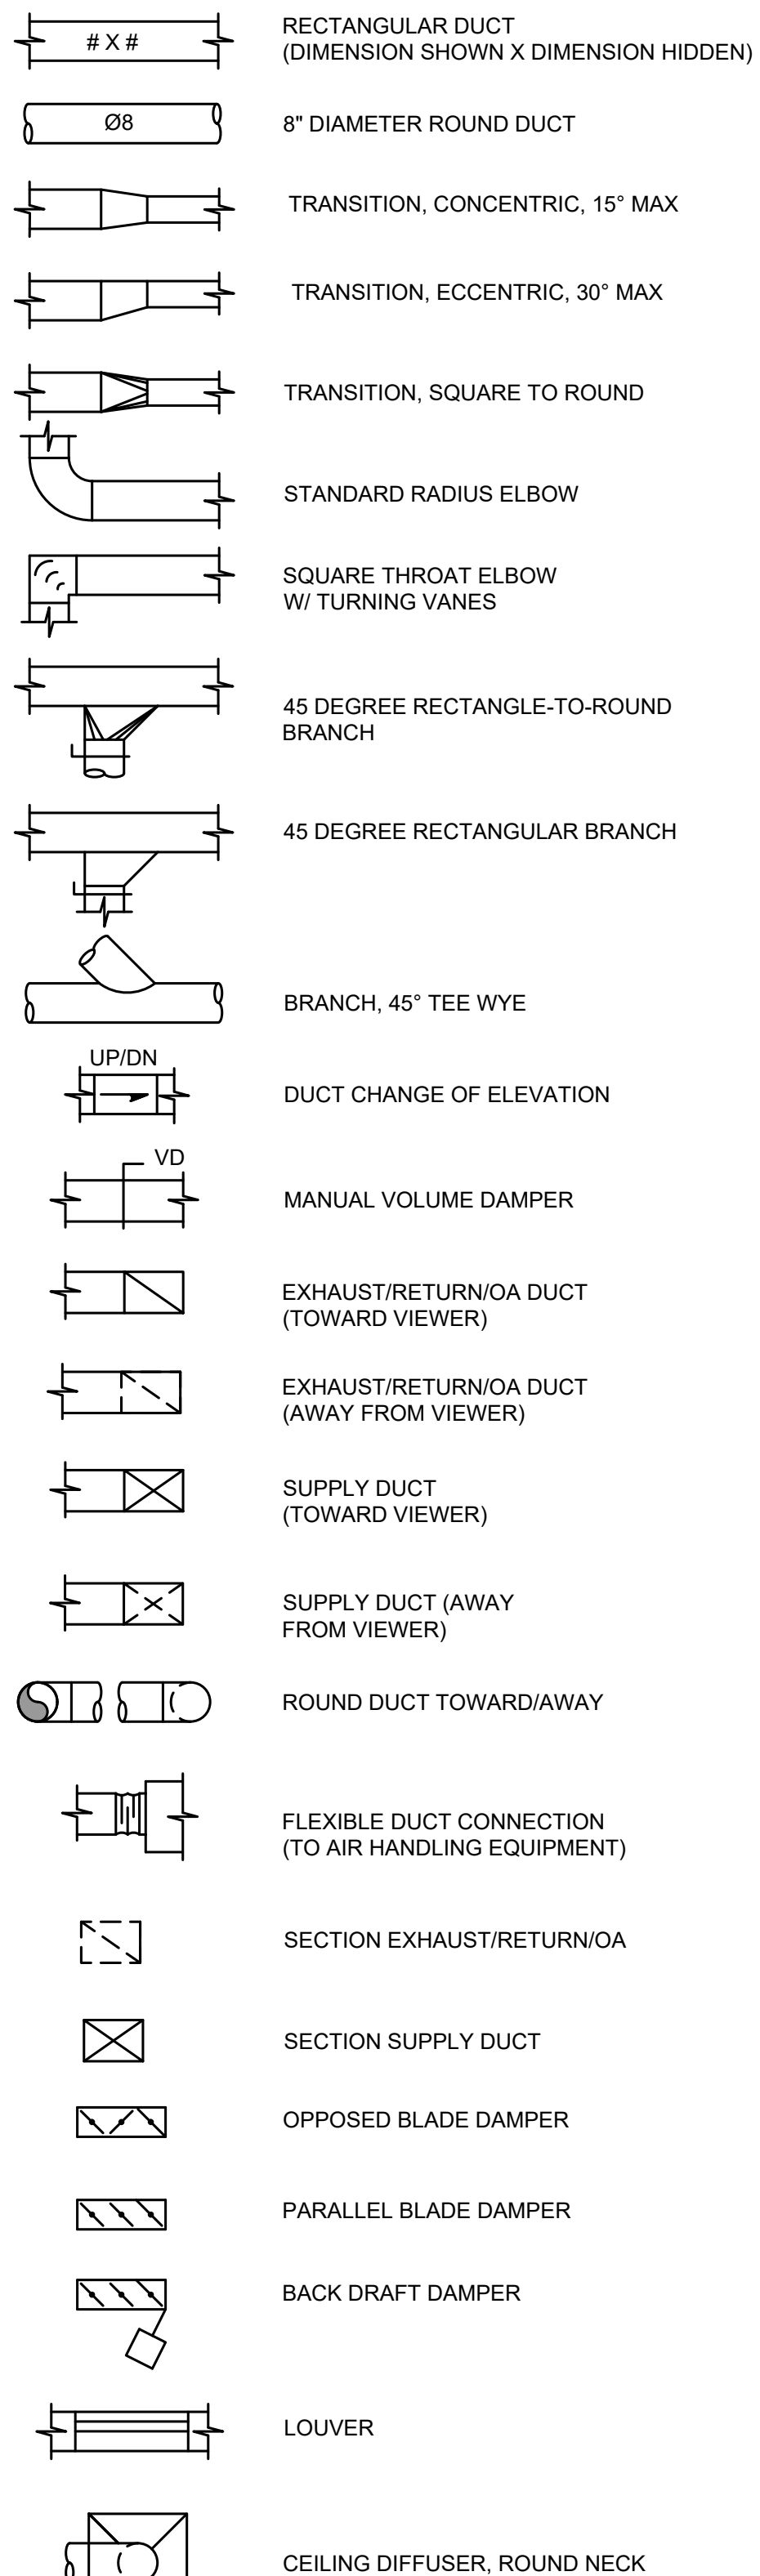


HVAC ABBREVIATIONS

A	AMPERE
ACH	AIR CHANGES PER HOUR
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AHJ	AUTHORITY HAVING JURISDICTION
BDD	BACK DRAFT DAMPER
BLDG	BUILDING
BTU	BRITISH THERMAL UNIT
CA	COMPRESSED AIR
CAP	CAPACITY
CD	CEILING DIFFUSER
CFM	CUBIC FEET PER MINUTE
CLG	CEILING
DIA	DIAMETER
DN	DOWN
EA	EXHAUST AIR
ECM	ELECTRONICALLY COMMUTATED MOTOR
EF	EXHAUST FAN
°F	DEGREES FAHRENHEIT
FS	FLOW SWITCH
GPM	GALLONS PER MINUTE
HOA	HAND/OFF/AUTO
MA	MIXED AIR
MBH	1,000 BTU'S/HR
MCA	MINIMUM CIRCUIT AMPS
MFR	MANUFACTURER
MOCPP	MAXIMUM OVER CURRENT PROTECTION
NA	NOT APPLICABLE
NC	NORMALLY CLOSED
NG	NATURAL GAS
NO	NORMALLY OPEN
OA	OUTSIDE AIR
POC	POINT OF CONNECTION
RA	RETURN AIR
SA	SUPPLY AIR
SP	STATIC PRESSURE
TEMP	TEMPERATURE
UNO	UNLESS NOTED OTHERWISE
V	VOLTS
VD	VOLUME DAMPER
VRF	VARIABLE REFRIGERANT FLOW
W	WATT
WC	WATER COLUMN
WP	WALL PENETRATION
WSEC	WASHINGTON STATE ENERGY CODE

HVAC GENERAL NOTES


- MATERIALS, METHODS AND INSTALLATION SHALL COMPLY WITH THE CONTRACT SPECIFICATIONS AND WITH THE PROVISIONS OF THE 2015 INTERNATIONAL MECHANICAL CODE, 2015 INTERNATIONAL BUILDING CODE, 2015 INTERNATIONAL FIRE CODE AS AMENDED BY THE STATE OF WASHINGTON AND THE LOCAL AUTHORITY HAVING JURISDICTION.
- THESE PLANS ARE SCHEMATIC AND DO NOT SHOW EXACT ROUTING OR EVERY OFFSET, WHICH MAY BE REQUIRED. THE HVAC CONTRACTOR IS TO COORDINATE WITH ALL OTHER TRADES AND IS TO VERIFY ALL CLEARANCES BEFORE COMMENCING WORK.
- CONTRACTOR SHALL VERIFY THE DIMENSIONS WITH THE EQUIPMENT MANUFACTURER TO PROVIDE DUCT TRANSITIONS TO HVAC VENTILATORS, FANS, LOUVERS, OR SUPPLY/EXHAUST GRILLES TO MATCH THE INLET/OUTLET DIMENSIONS OF THE EQUIPMENT.
- PROVIDE EARTHQUAKE RESTRAINT FOR HVAC EQUIPMENT IN ACCORDANCE WITH SMACNA RESTRAINT MANUAL AS REQUIRED BY 2015 INTERNATIONAL BUILDING CODE REQUIREMENTS.
- CONSTRUCTION, SUPPORTS AND INSTALLATION SHALL BE INSTALLED AND COMPLY WITH THE 2015 INTERNATIONAL MECHANICAL CODE (IMC) AND WITH SMACNA HVAC DUCT CONSTRUCTION STANDARDS-METAL AND FLEXIBLE.
- ALL DUCTWORK IS CLASSIFIED AS LOW PRESSURE.
- BALANCING: ALL HVAC SYSTEMS SHALL BE BALANCED BY A LICENSED CONTRACTOR IN ACCORDANCE WITH ACCEPTED ENGINEERING STANDARDS AND SPECIFICATION. AN AIR BARRIER TEST SHALL BE PERFORMED IN ACCORDANCE WITH THE WASHINGTON STATE ENERGY CODE AND ASTM E779.
- LOCATE THERMOSTATS 5 FEET AFF. UNLESS OTHERWISE NOTED.
- PROVIDE FLEXIBLE DUCT CONNECTIONS ON ALL DUCTWORK CONNECTING TO EQUIPMENT.
- EQUIPMENT DRAIN PIPING SHALL MAINTAIN A MIN HORIZONTAL SLOPE IN THE DIRECTION OF DISCHARGE OF MIN -1/8 INCH VERTICAL PER 1 FOOT HORIZONTAL.
- CONTRACTOR SHALL COORDINATE CEILING EQUIPMENT LOCATIONS WITH ARCHITECTURAL REFLECTED CEILING PLANS AND ELECTRICAL LIGHTING LAYOUT.
- EQUIPMENT CONDENSATE DRAINS SHALL BE TRAPPED AS REQUIRED BY THE EQUIPMENT OR APPLIANCE MANUFACTURER.
- REFRIGERANT PIPING SHALL BE INSTALLED WITH CLOSED CELL ELASTOMERIC INSULATION IN ACCORDANCE WITH SPECIFICATION 15700. INSULATION EXPOSED TO OUTSIDE CONDITIONS SHALL BE ENCLOSED BY A LINE-HIDE LINESET COVER SYSTEM.
- BUILDING HVAC DOCUMENTS SUCH AS RECORDS, CALCULATIONS, COMPLIANCE FORMS, AND EQUIPMENT MANUALS SHALL BE SUPPLIED TO THE BUILDING OWNER.

HVAC EQUIPMENT & AIR DEVICE IDENTIFICATIONS

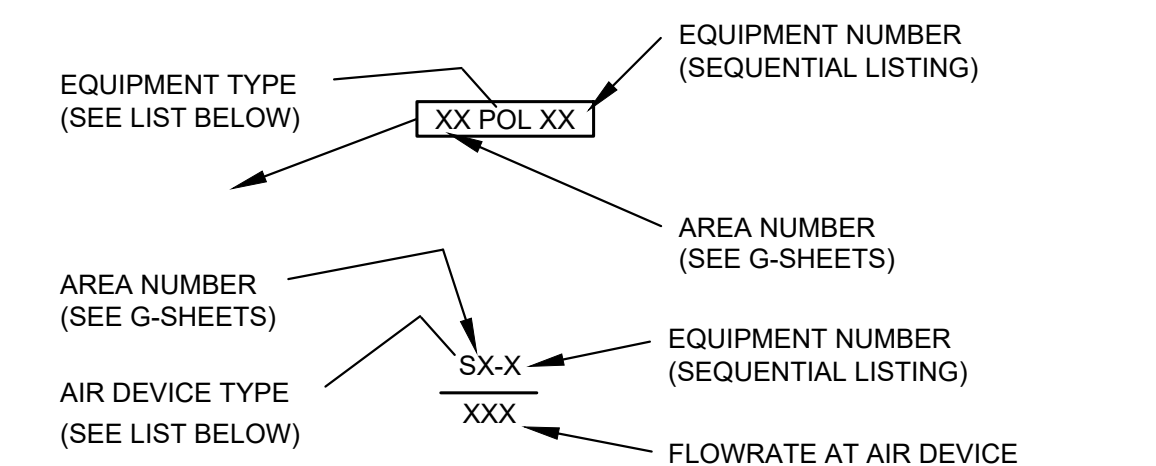

EQUIPMENT	AIR DEVICE
AC	AIR CONDITIONER
BC	BRANCH CONTROLLER
C	CONTROLLER
CU	CONDENSING UNIT
DS	DUCT STAT
EF	EXHAUST FAN
FC	FAN COIL
FS	FLOW SWITCH
HP	HEAT PUMP
HT	HEATER
MD	MOTORIZED DAMPER
SF	SUPPLY FAN
T	THERMOSTAT
VD	VOLUME DAMPER
E	EXHAUST GRILLE
LVR	LOUVER
R	RETURN GRILLE
S	SUPPLY DIFFUSER/GRILLE

Gray & Osborne, Inc.
 CONSULTING ENGINEERS
 1130 RAINIER AVENUE SOUTH,
 SUITE 300
 SEATTLE, WASHINGTON 98144
 (206) 284-0860

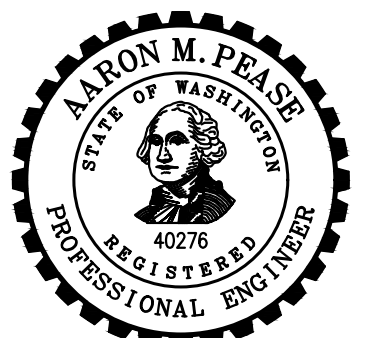

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
 1602 18TH ST NW,
 PUYALLUP, WA 98371

PRELIMINARY
NOT FOR
CONSTRUCTION

No.	DATE	REVISION

ISSUED FOR:
 90% DESIGN REVIEW

ISSUE DATE: DECEMBER 2021

APPROVED BY: AMP

CHECKED BY: DASU

DRAWN BY: ASD

DESIGNER: ABE

G & O JOB NO.: 21462

FILE: H_RASWAS.DWG

0 1" 2"
 TWO INCHES AT FULL SCALE.
 IF NOT, SCALE ACCORDINGLY

HVAC
AREA 6

NOTES AND
ABBREVIATIONS

DRAWING: **H6-1** OF: **3**

APPROVED

BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP

APPROVED
 DATE: _____

EXPIRATION
 DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans.

Field conditions may dictate changes to these plans as determined by the City Engineer.

FAN SCHEDULE								
BUILDING	ROOM NAME	UNIT NO.	TYPE	MANUFACTURER & MODEL NO.	HP, VOLTAGE, AND PHASE	CONTROLS	CFM AND STATIC PRESSURE	REMARKS
RAS/WAS PUMP STATION	RAS/WAS PUMP ROOM	06 EF 01	ROOF EXHAUST FAN	GREENHECK CUE-180-VG OR EQUAL	3/4 HP 115 V 1 Ø	CONTINUOUS	1,600 CFM @ 0.2" WC	PROVIDE THERMAL OVERLOAD, NEMA 4X DISCONNECT, ALUMINUM HOUSING, S.S. FASTENERS, S.S. SHAFT, & HI-PRO POLYESTER FINISH.
		06 SF 01	ROOF SUPPLY FAN	GREENHECK RBF-1H20 OR EQUAL	1/4 HP 115 V 1 Ø	CONTINUOUS	1,500 CFM @ 0.2" WC	PROVIDE THERMAL OVERLOAD, NEMA 4X DISCONNECT, ALUMINUM HOUSING, S.S. FASTENERS, S.S. SHAFT, 2" ALUMINUM MESH FILTERS, & HI-PRO POLYESTER FINISH.

GRILLE/DIFFUSER SCHEDULE						
BUILDING	ROOM NAME	DIFFUSER/GRILLE NO.	TYPE	MANUFACTURER & MODEL NO.	SIZE (WxL)	REMARKS
RAS/WAS PUMP STATION	RAS/WAS PUMP ROOM	1A	SUPPLY GRILLE	PRICE 95 OR EQUAL	20"x20"	PROVIDE DUCT MOUNTING, AND BAKED ENAMEL FINISH.
		1B	EXHAUST GRILLE	PRICE 95 OR EQUAL	20"x20"	PROVIDE DUCT MOUNTING, AND BAKED ENAMEL FINISH.


HEATER SCHEDULE									
BUILDING	ROOM NAME	UNIT NO.	TYPE	MANUFACTURER & MODEL NO.	KW OUTPUT	CONTROLS	VOLTAGE AND PHASE	MOUNTING TYPE	REMARKS
RAS/WAS PUMP STATION	PUMP ROOM	06 HT 01	DUCT HEATER	INDEECO QUA OR EQUAL	20 KW	06 T 03	480 V 3 Ø	SLIP-IN, VERTICAL DOWN AIR FLOW, 22"x22" DUCT	PROVIDE DISCONNECT, DUST TIGHT TERMINAL BOX, INSULATED TERMINAL BOX, 24 V CONTROL TRANSFORMER AND CONTACTORS, PILOT LIGHT "ON" & "LOW AIRFLOW", S.S. FRAME.

HEAT PUMP SCHEDULE											
BUILDING	ROOM NAME	UNIT NO.	TYPE	MANUFACTURER & MODEL NO.	VOLTAGE, PHASE AND MCA	CONTROLS	STANDARD AIRFLOW	HEATING CAPACITY	COOLING CAPACITY	AHRI LISTED EFFICIENCY	REMARKS
RAS/WAS PUMP STATION	MOTOR CONTROL CENTER	06 HP 01	OUTDOOR HEAT PUMP	mitsubishi PUZ-A24NHA7 OR EQUAL	208 V 1 Ø 19 A	06 FC 01	-1,900 CFM	15.7 MBH @ 17 °F OAT	24.0 MBH @ 95 °F OAT	21.4 SEER 11.0 HSPF	PROVIDE INSULATED LINE SET, INSULATED DRAIN PIPE, LINE HIDE SET, WIND BAFFLE, AND MITSUBISHI REMOTE ADAPTER WIRING HARNESS (PART #PAC-725AD)
		06 FC 01	WALL MOUNTED FAN COIL	mitsubishi PKA-A24KA7 OR EQUAL	208 V 1 Ø 2 A	06 T 01	570-775 CFM				PROVIDE CONDENSATE PUMP. LOCATE ABOVE DOOR.
		06 HP 02	OUTDOOR HEAT PUMP	mitsubishi PUZ-A24NHA7 OR EQUAL	208 V 1 Ø 19 A	06 FC 02	-1,900 CFM	15.7 MBH @ 17 °F OAT	24.0 MBH @ 95 °F OAT	21.4 SEER 11.0 HSPF	PROVIDE INSULATED LINE SET, INSULATED DRAIN PIPE, LINE HIDE SET, WIND BAFFLE, AND MITSUBISHI REMOTE ADAPTER WIRING HARNESS (PART #PAC-725AD)
		06 FC 02	WALL MOUNTED FAN COIL	mitsubishi PKA-A24KA7 OR EQUAL	208 V 1 Ø 2 A	06 T 02	570-775 CFM				PROVIDE CONDENSATE PUMP. LOCATE ABOVE DOOR.

NOTE: HEATING AND COOLING CAPACITIES ARE ASSUMING 70 °F AND 80 °F INDOOR TEMPERATURES RESPECTIVELY, PER THE MANUFACTURER

CONTROL SCHEDULE										
BUILDING	ROOM NAME	UNIT NO.	TYPE	CONTROLLED EQUIPMENT	MANUFACTURER & MODEL NO.	HEAT SET POINT	COOL SET POINT	VOLTAGE AND PHASE	REMARKS	
RAS/WAS PUMP STATION	MOTOR CONTROL CENTER	06 T 01	PROGRAMMABLE THERMOSTAT	06 FC 01	mitsubishi PAR-40MAAU OR EQUAL	45 °F	95 °F	12 VDC		
		06 T 02	PROGRAMMABLE THERMOSTAT	06 FC 02	mitsubishi PAR-40MAAU OR EQUAL	45 °F	95 °F	12 VDC		
	RAS/WAS PUMP ROOM	06 FS 01	FLOW SWITCH	N/A	DEGREE CONTROLS S500 OR EQUAL	N/A	N/A	120 V 1 Ø	MOUNT INSIDE SUPPLY DUCT.	
		06 FS 02	FLOW SWITCH	N/A	DEGREE CONTROLS S500 OR EQUAL	N/A	N/A	120 V 1 Ø	MOUNT INSIDE EXHAUST DUCT.	
		06 T 03	THERMOSTAT	06 HT 01						

Gray & Osborne, Inc.
CONSULTING ENGINEERS
1130 RAINIER AVENUE SOUTH,
SUITE 300
SEATTLE, WASHINGTON 98144
(206) 284-0860

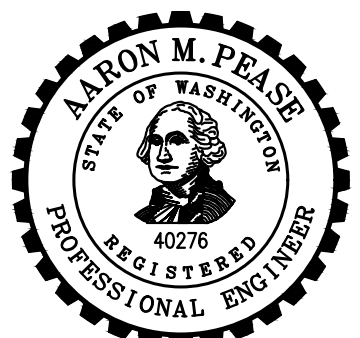

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: AMP		
CHECKED BY: DASD		
DRAWN BY: ASD		
DESIGNER: ABE		
G & O JOB NO.: 21462		
FILE: H_RASWAS.DWG		

0 1" 2"
TWO INCHES AT FULL SCALE.
IF NOT, SCALE ACCORDINGLY


**HVAC
AREA 6**

**EQUIPMENT
SCHEDULES**

DRAWING: **H6-2** OF: **3**


APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

m:\PUYALLUP\21462\wpcp\3rd_secondary_clarifier\01_design\Plan\setHVACH_H_RASWAS.dwg, 1/3/2022 2:20 PM, CHARLEY REID

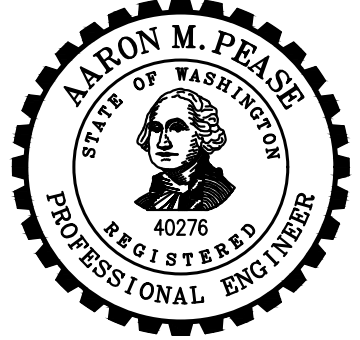



**PRELIMINARY
 NOT FOR
 CONSTRUCTION**

No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: AMP		
CHECKED BY: DASU		
DRAWN BY: ASD		
DESIGNER: ABE		
G & O JOB NO.: 21462		
FILE: H_RASWAS.DWG		





**HVAC
 AREA 6**

**DEMOLITION AND
 PROPOSED PLANS**

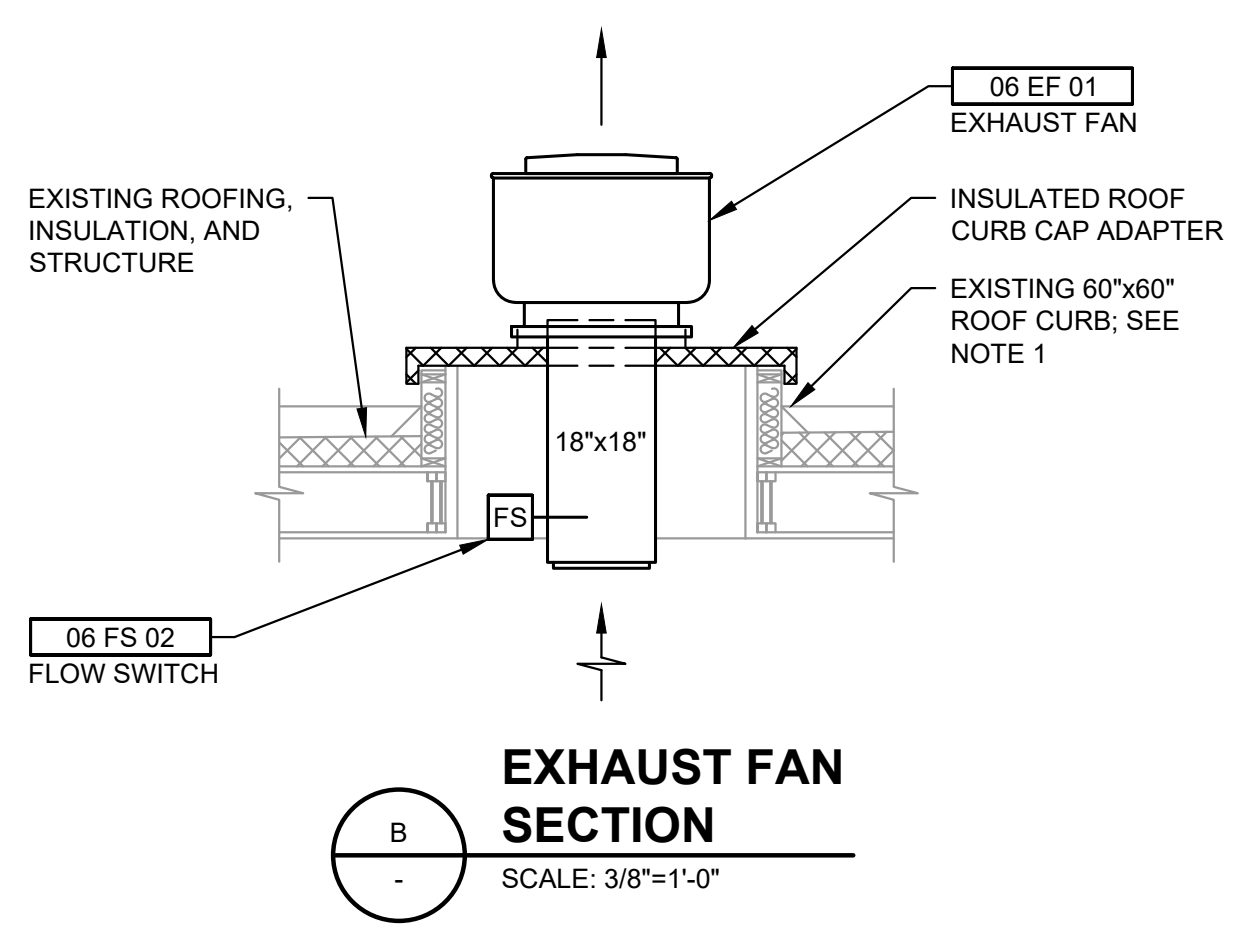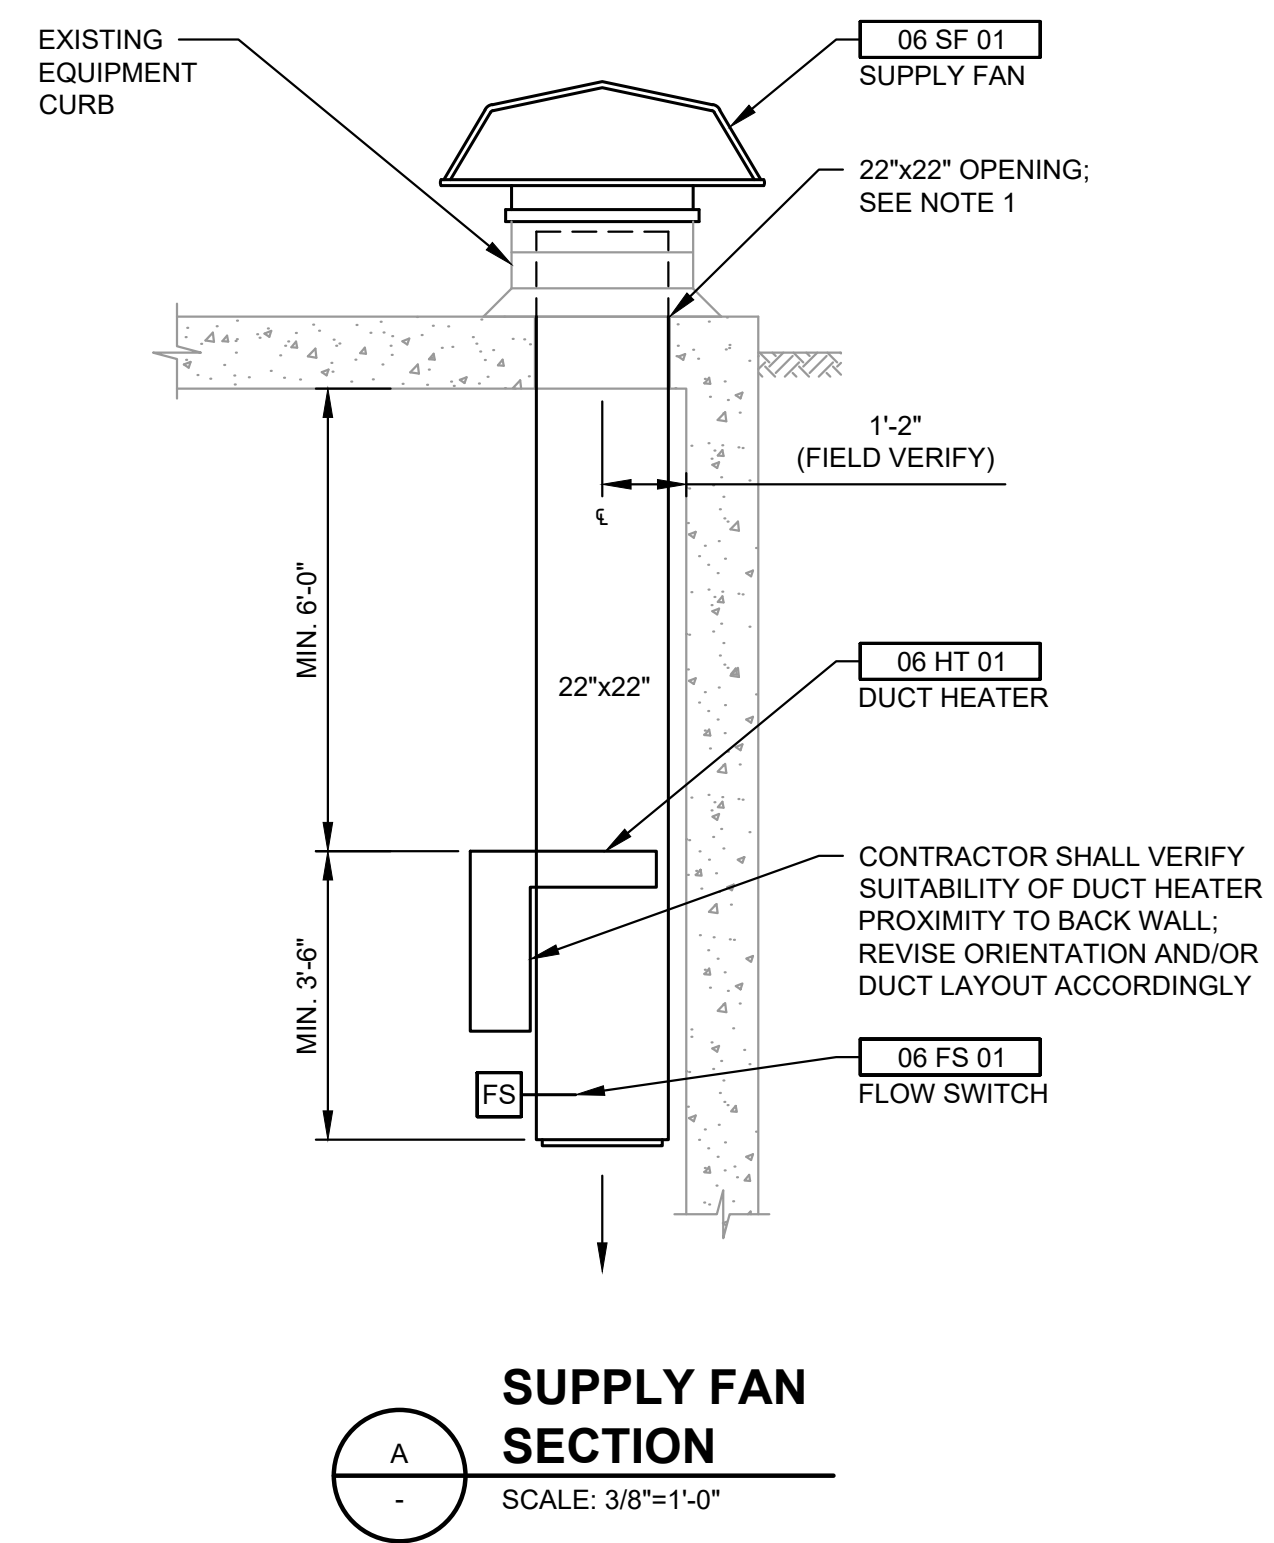

NOTE:
 1. ROOF PENETRATIONS AND CONSTRUCTION IS BASED ON AVAILABLE INFORMATION; CONTRACTOR TO FIELD VERIFY.

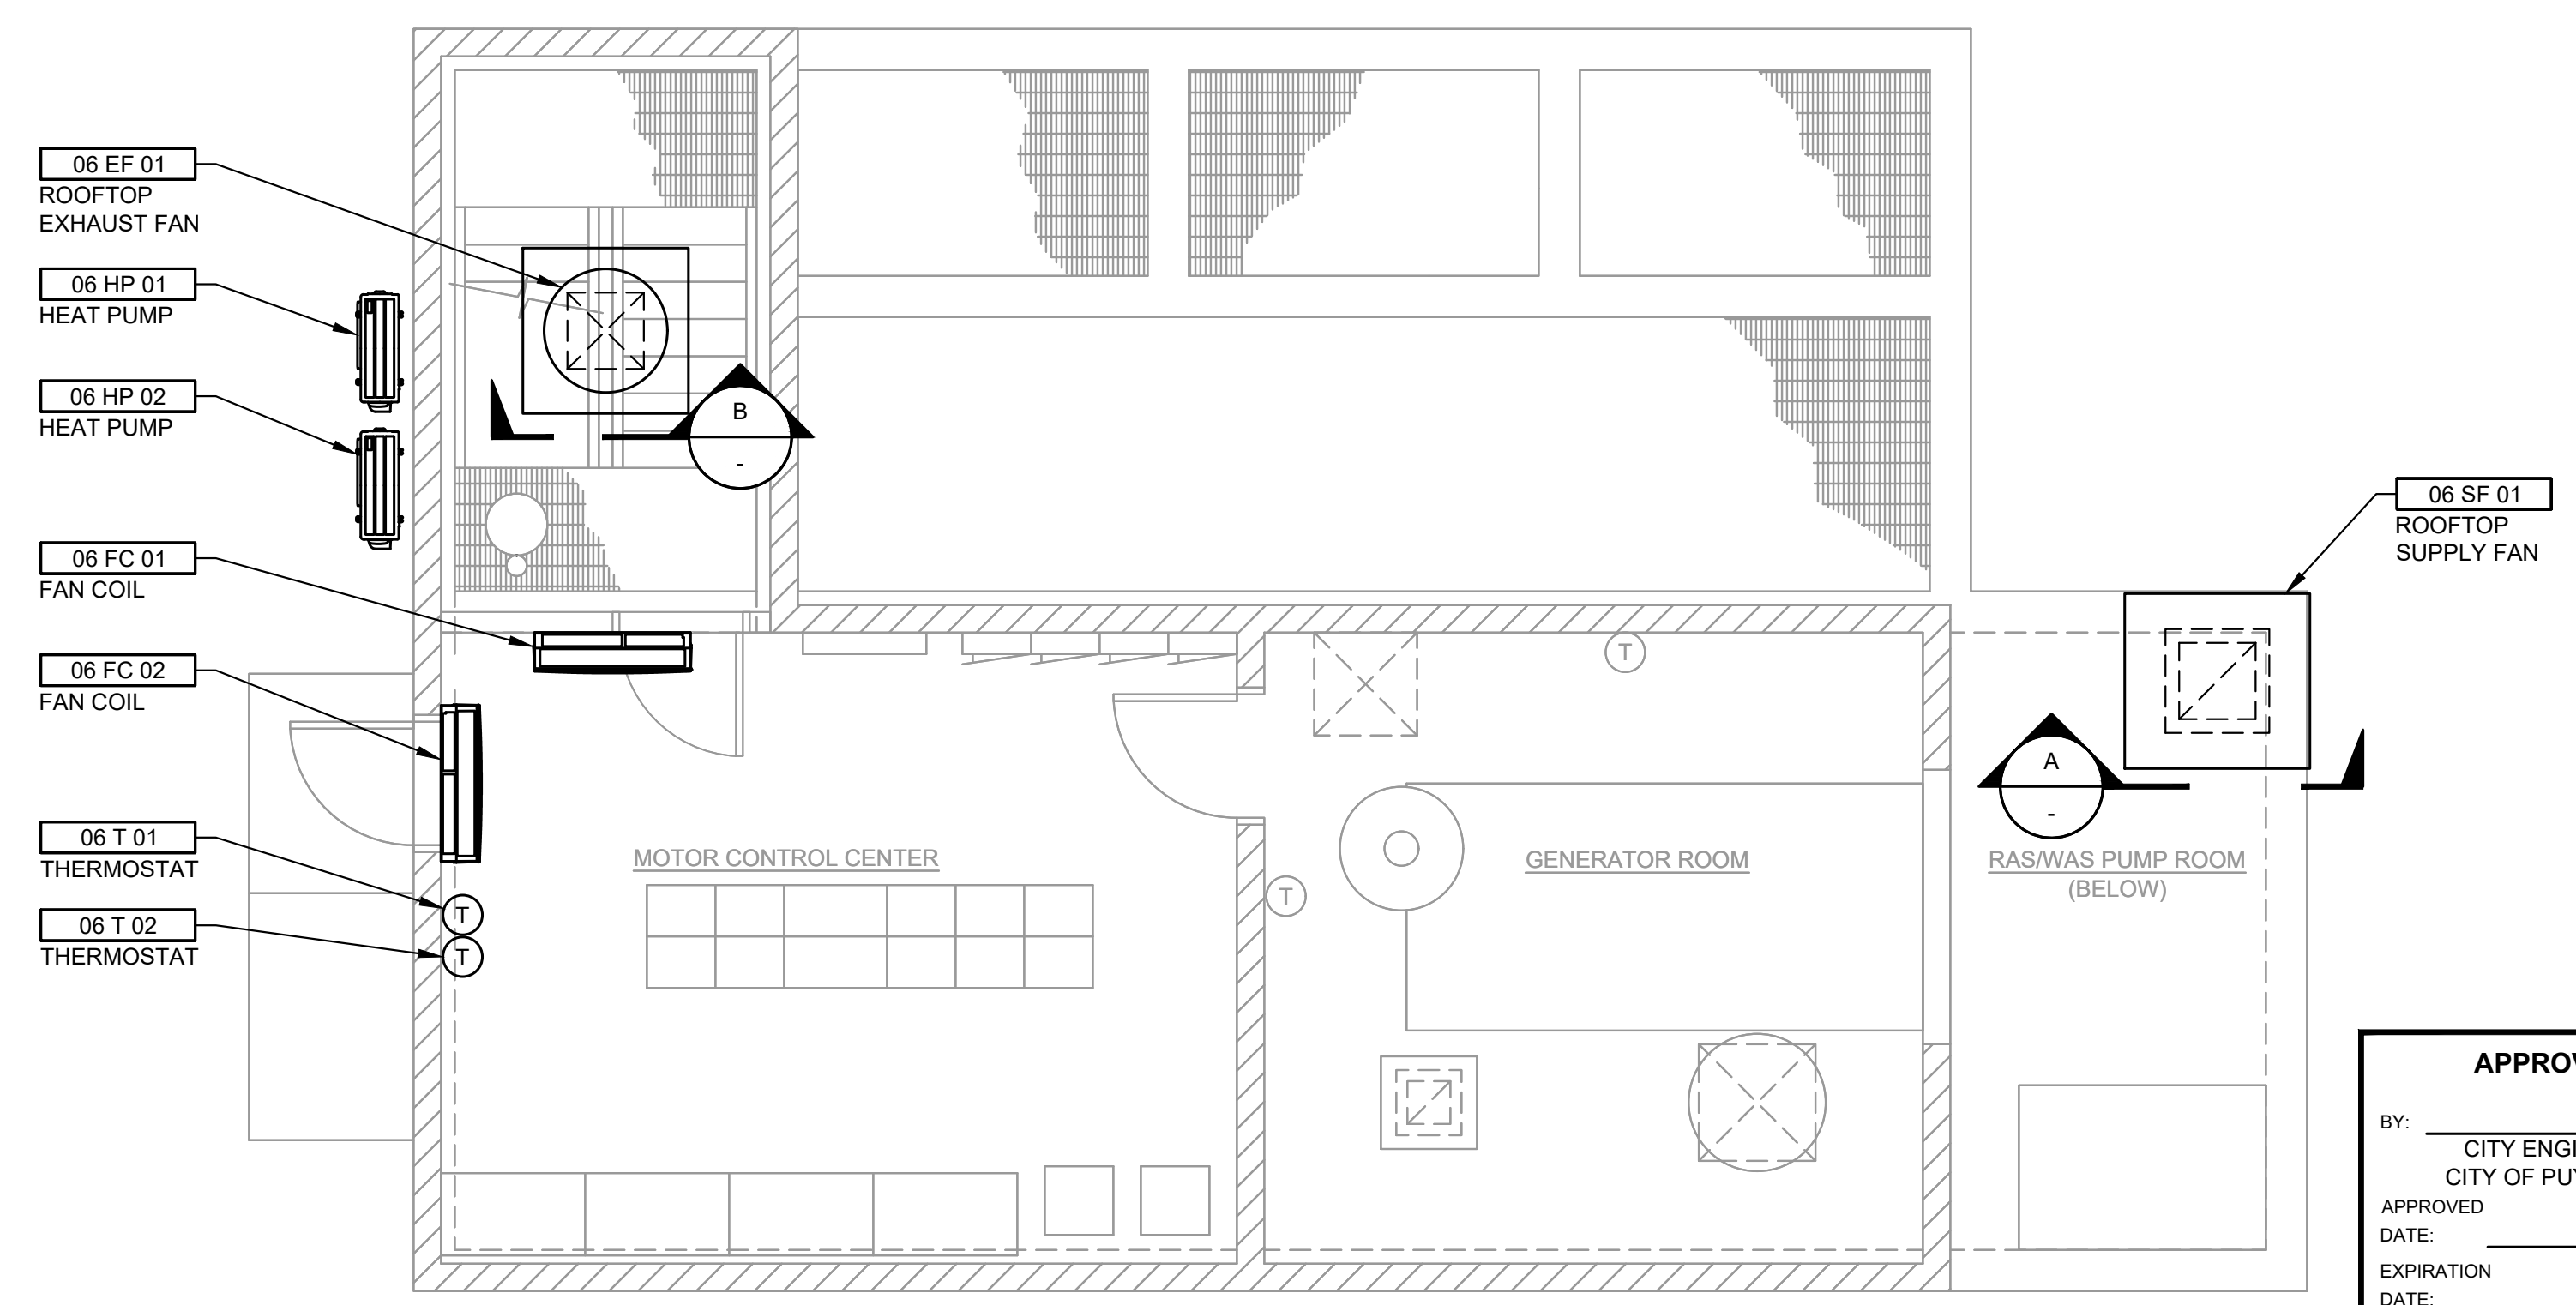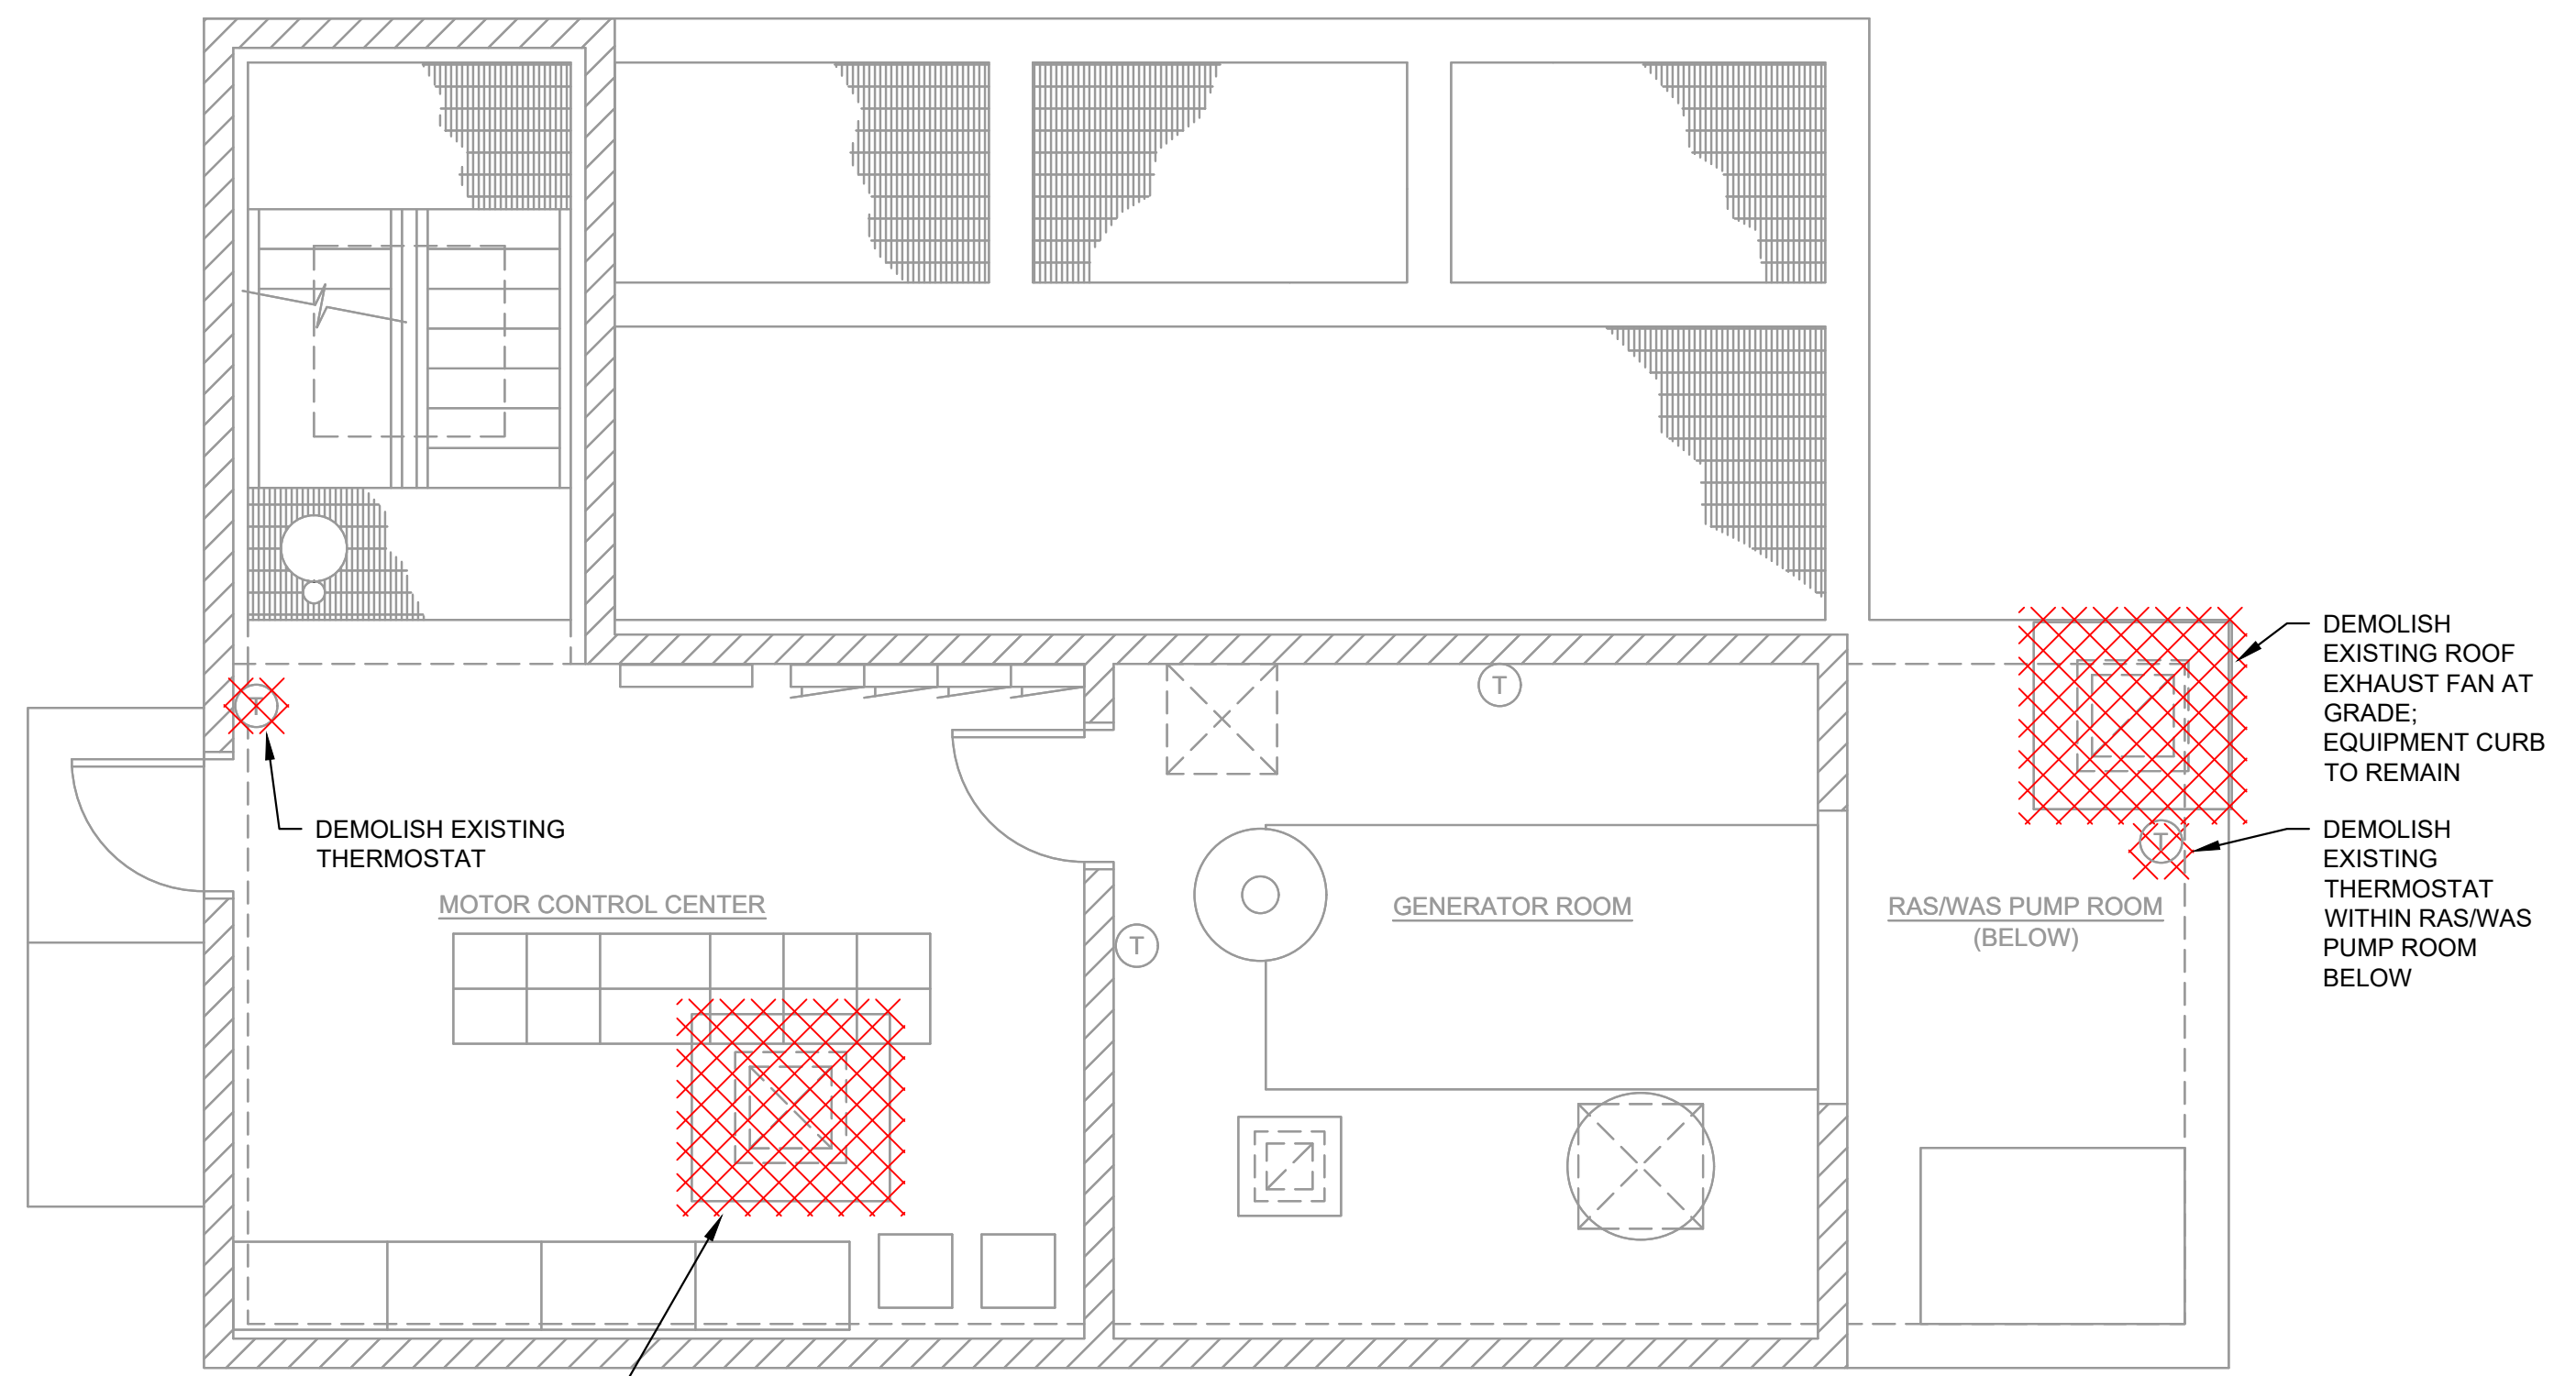

APPROVED
 BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP
 APPROVED
 DATE: _____
 EXPIRATION
 DATE: _____
 NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
 The City will not be responsible for errors and/or omissions on these plans.
 Field conditions may dictate changes to these plans as determined by the City Engineer.

m:\PUYALLUP\21462 wpccp 3rd secondary clarifier\01 design\PlanSet\HVACH_H_RASWAS.dwg, 1/3/2022 2:20 PM, CHARLEY REID

WATER PIPING NOTES

NOTES:


1. INSTALL SHUT OFF VALVE TO ISOLATE WATER CLOSET SINKS AND DISH WASHER.
2. PROVIDE WATER HAMMER ARRESTOR (MINIMUM 12" AIR CHAMBER) AT SINKS.
3. ALL WATER PIPES SHALL BE COPPER.
4. ALL PIPING TO BE CONCEALED IN INTERIOR WALLS, CEILINGS, OR IN UTILITY SPACE BEHIND LABORATORY FURNITURE.
5. USE WALL AND CEILING FLANGE AT WALL AND CEILING PENETRATIONS.
6. ALL EXPOSED NON-POTABLE AND PROCESS WATER PIPING INCLUDING HOSE BIBS, SHALL BE LABELED EVERY 3 TO 5 FEET - "DANGER-UNSAFE WATER".
7. ALL HOT WATER PIPING SHALL BE 1/2" DIAMETER, UNLESS OTHERWISE NOTED ON PLANS, AND SHALL BE INSULATED W/ FIBERGLASS WRAP OUTSIDE.

DRAINAGE PIPING NOTES



NOTES:

1. DRAIN PIPE UNDER SLAB TO CI SOIL PIPE WITH SLOPE 1/4"/FT FOR PIPES < 3", SLOPE 1/8"/FT FOR PIPES > 3".
2. FLOOR DRAIN (FD) TO BE 3".
3. ALL BENDS UNDER FLOOR TO BE 45° FITTING MAXIMUM.
4. ALL FIXTURES SHALL BE TRAPPED.
5. ALL PLUMBING WORK SHALL CONFORM WITH THE MOST RECENT UNIFORM PLUMBING CODE OR SHALL BE APPROVED BY THE LOCAL BUILDING OFFICAL.
6. ALL DRAIN PIPING TO BE CAST IRON (CI).

WATER PIPING LEGEND

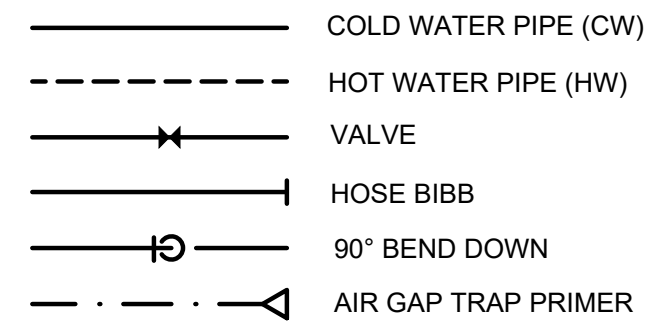

DRAINAGE PIPING LEGEND

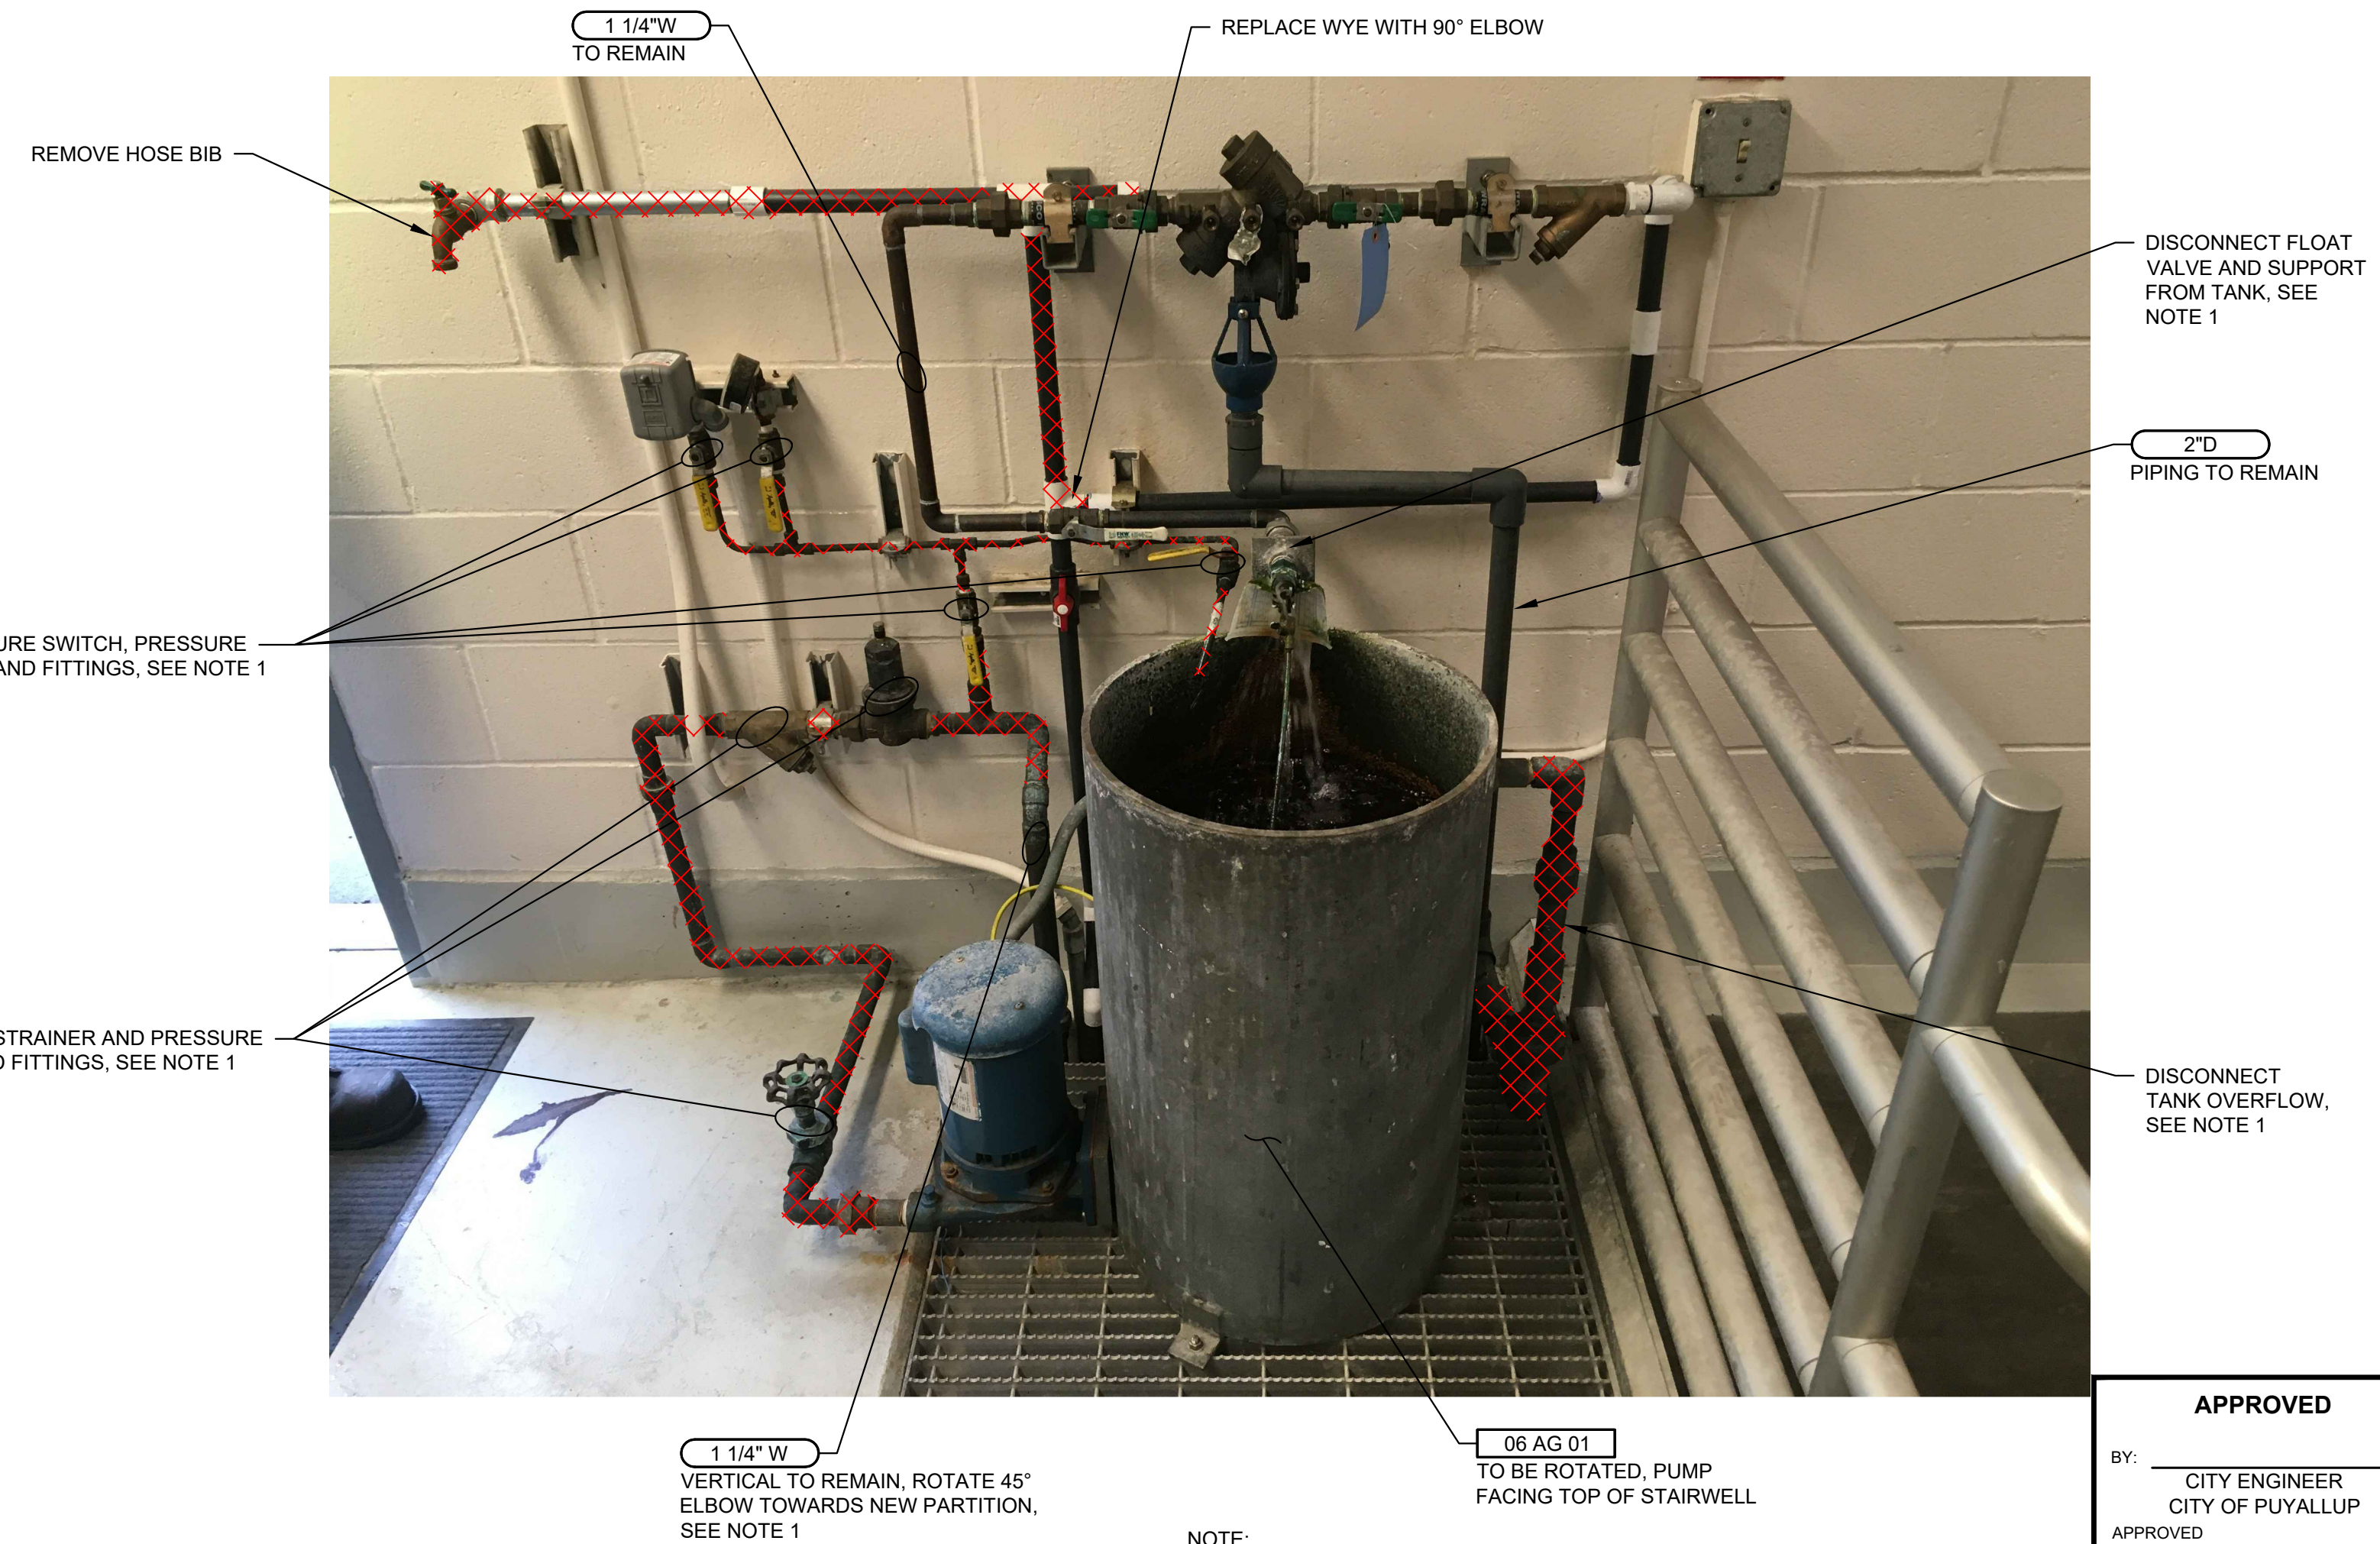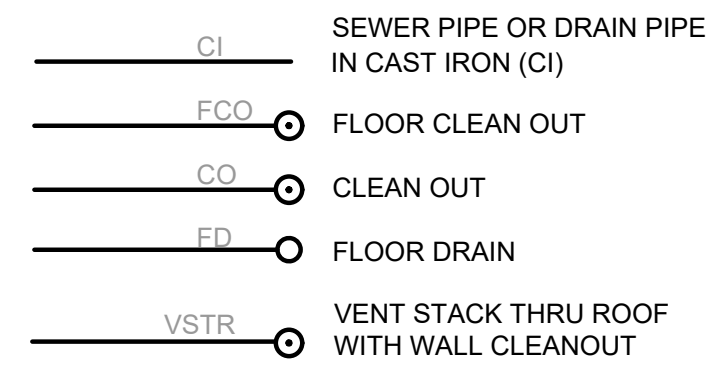

- NOTE:
1. MODIFY AIR GAP UNIT PIPING AS SHOWN ON SHEET P6-2.

1
P6-2 **PHOTO DETAIL**
NOT TO SCALE

APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP


APPROVED DATE: _____

EXPIRATION DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.


The City will not be responsible for errors and/or omissions on these plans.

Field conditions may dictate changes to these plans as determined by the City Engineer.



PRELIMINARY
NOT FOR
CONSTRUCTION


No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: <i>AMR</i>		
CHECKED BY: <i>ASB</i>		
DRAWN BY: <i>ASB</i>		
DESIGNER: <i>AMR</i>		
G & O JOB NO.: 21462		
FILE: P6_PLUMB.DWG		

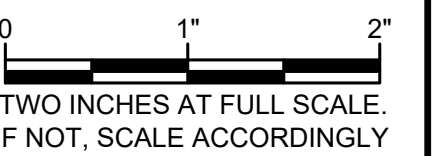



PLUMBING
AREA 6

PLUMBING NOTES,
LEGEND AND DETAILS

m:\PUYALLUP\21462 wpcp 3rd secondary clarifier\01 design\plan\set\p6_plumb.dwg, 1/3/2022 2:20 PM, CHARLEY REID

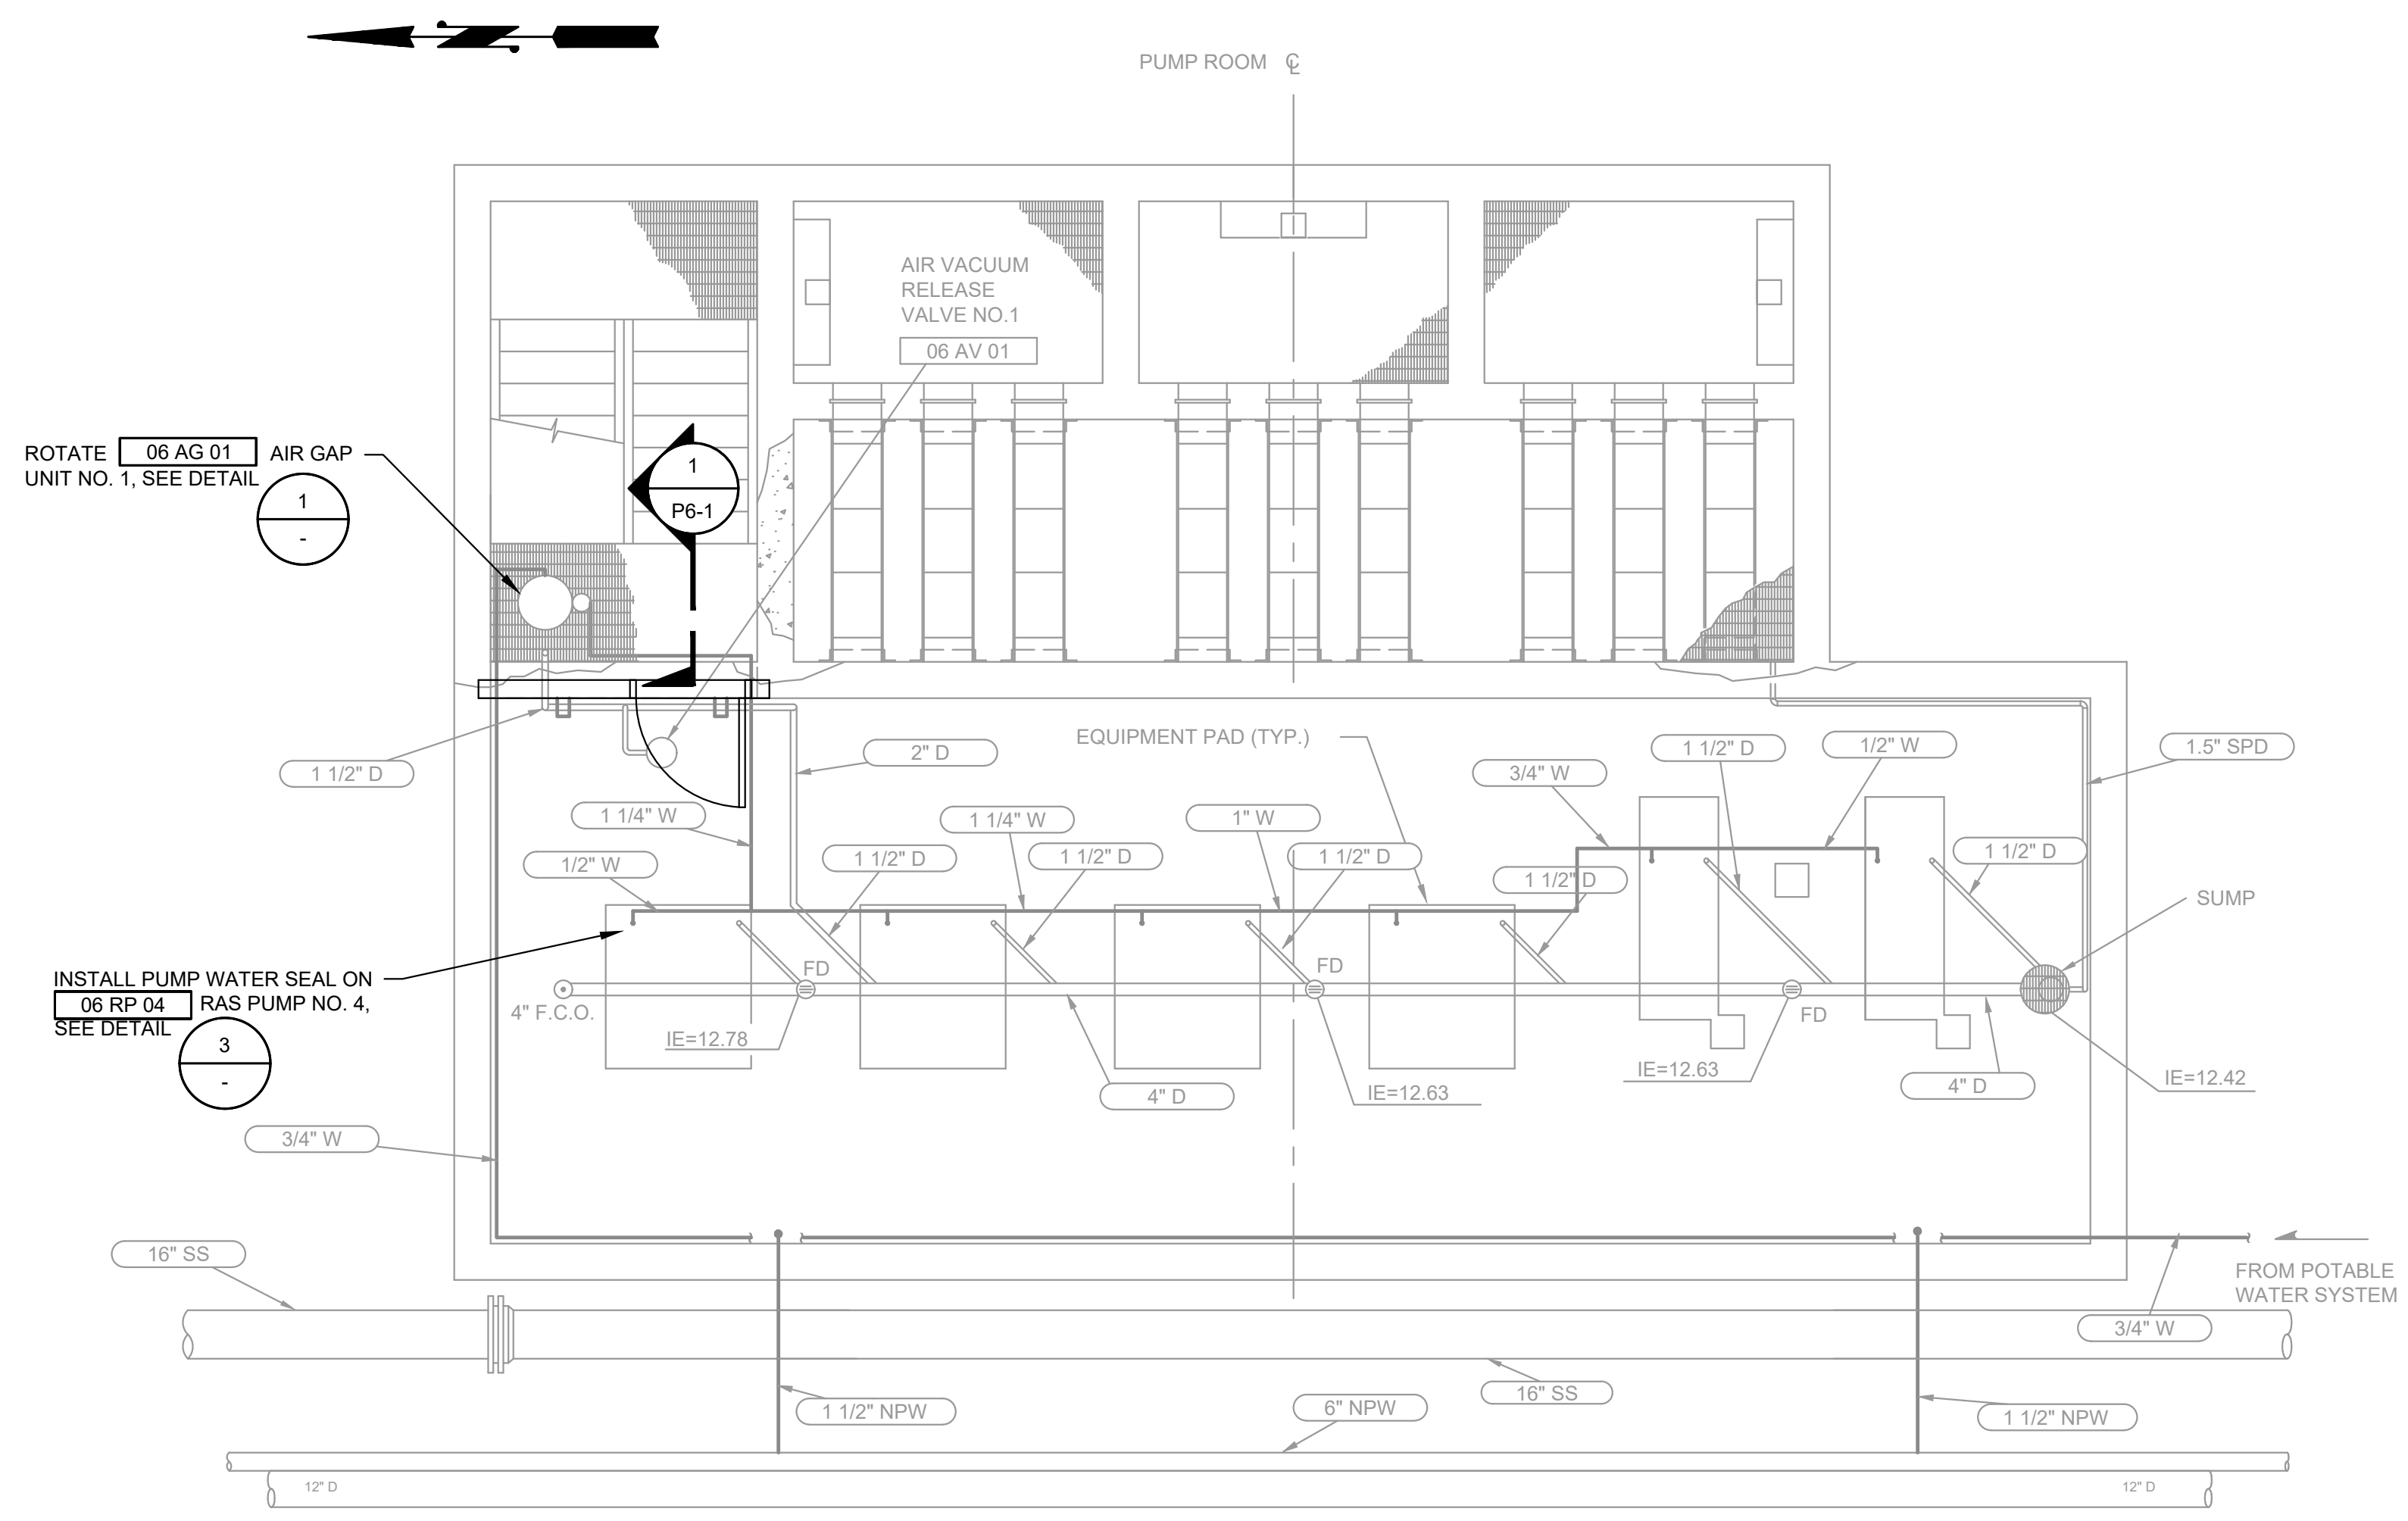


SECONDARY CLARIFIER SPLITTER BOX AND RAS/WAS PUMP STATION PLAN
SCALE: 1/4"=1'-0"

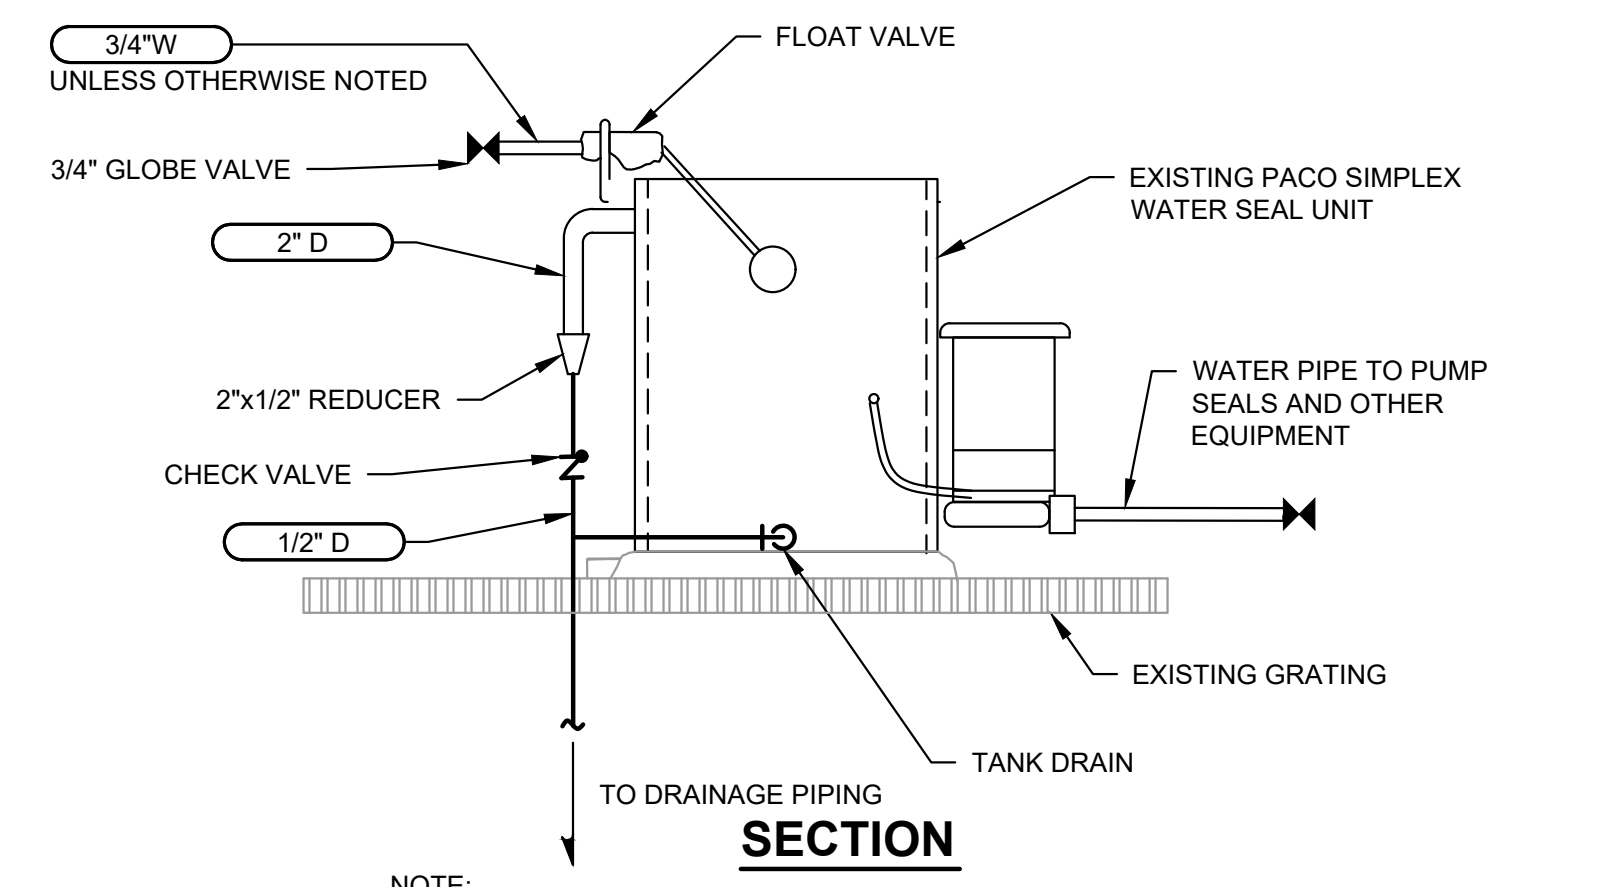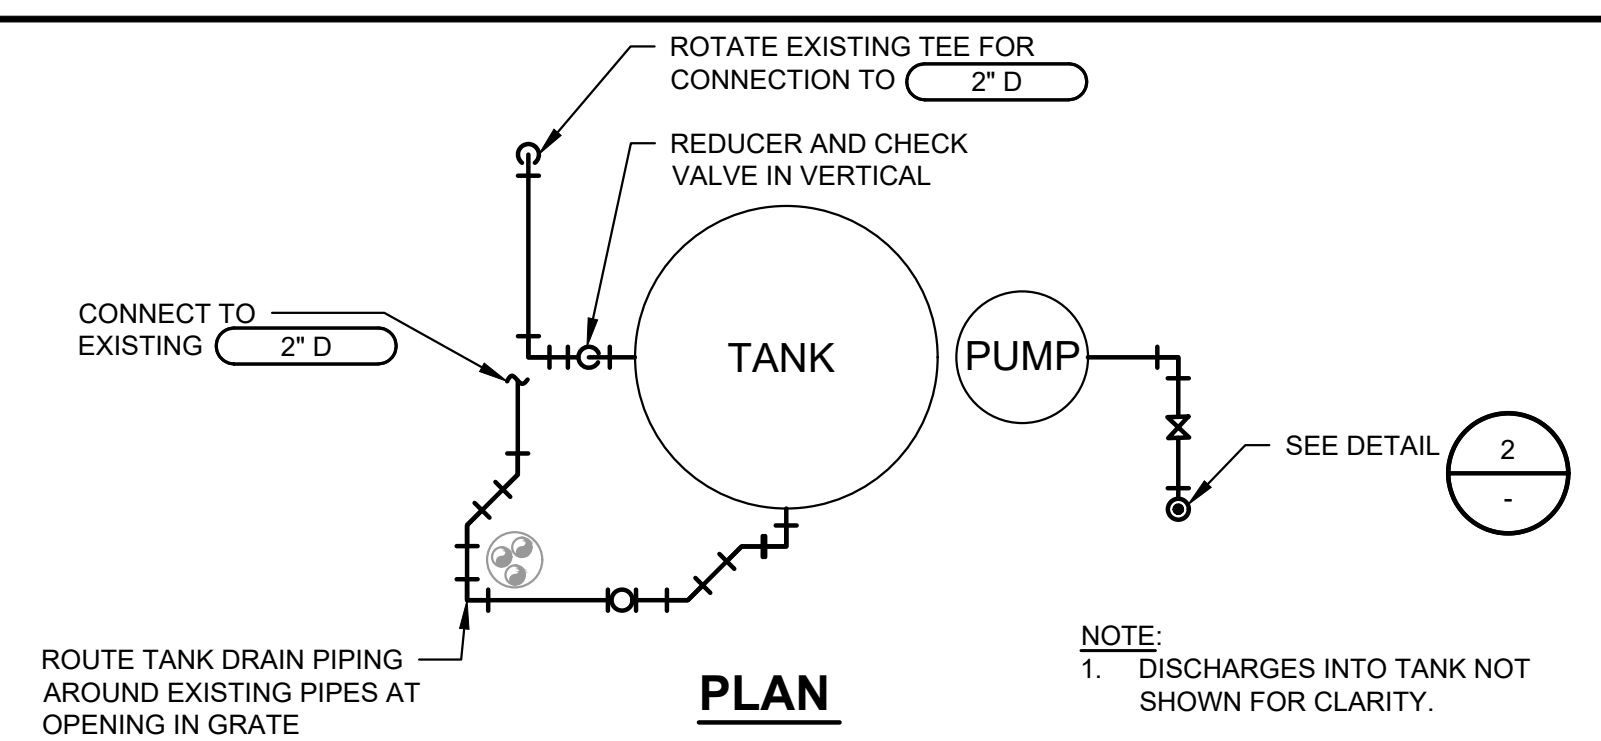


NOTE:
1. WHEN AIR GAP UNIT IS TO BE MOUNTED ON GRATING, PROVIDE 1/2\"/>

1 AIR GAP UNIT DETAIL
TYP NOT TO SCALE

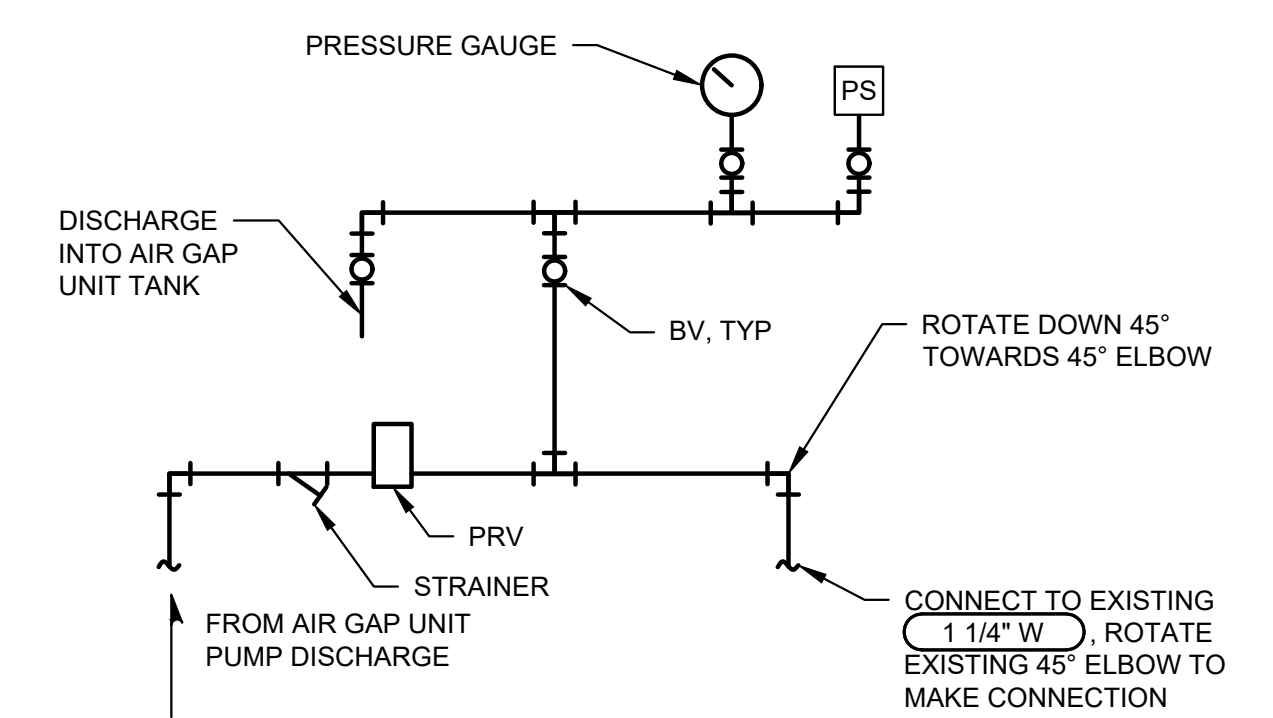

NOTE:
1. SUPPORT PIPING ON NEW PARTITION. INSTALL PIPE SUPPORTS IN ACCORDANCE WITH SPECIFICATIONS.

2 AIR GAP UNIT PIPING SCHEMATIC DETAIL
TYP NOT TO SCALE

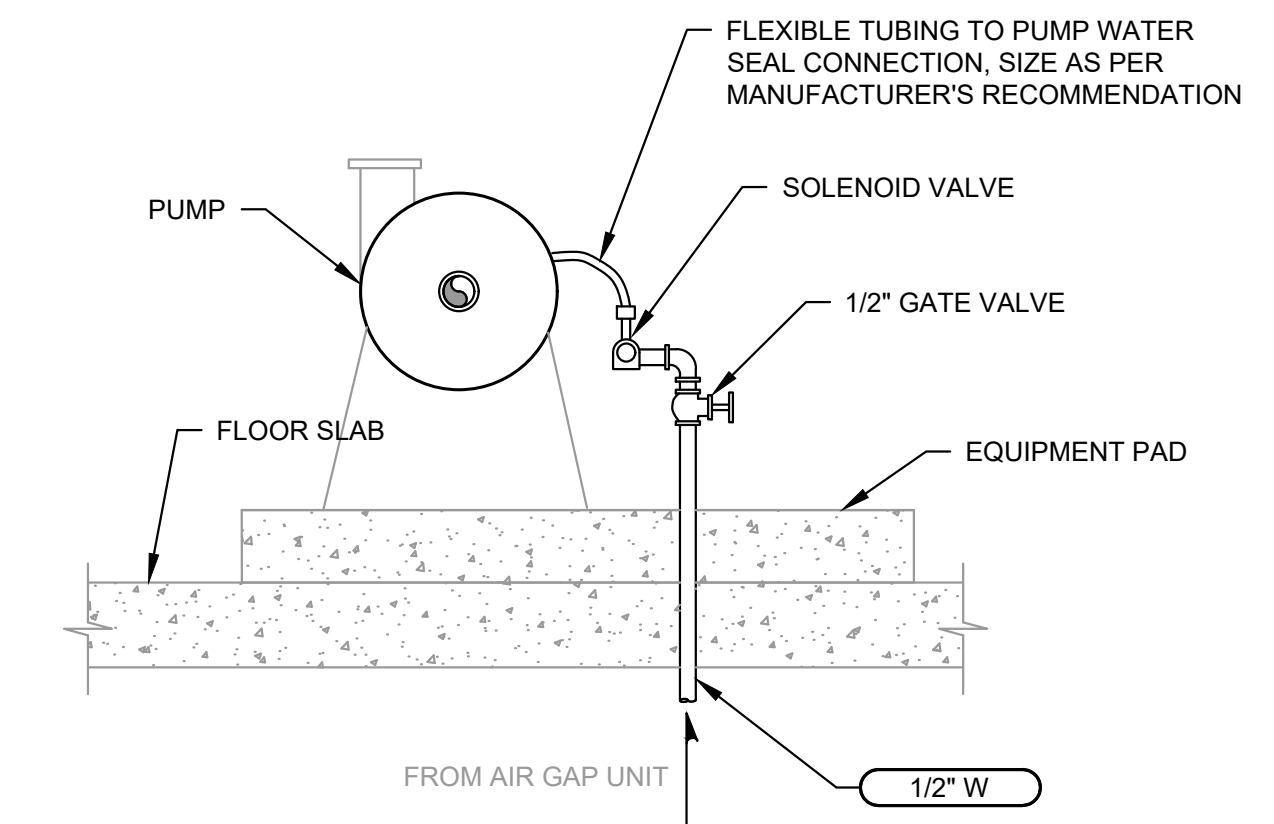

3 PUMP WATER SEAL DETAIL
TYP NOT TO SCALE


APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP

APPROVED DATE: _____
EXPIRATION DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.


Gray & Osborne, Inc.
CONSULTING ENGINEERS
1130 RAINIER AVENUE SOUTH,
SUITE 300
SEATTLE, WASHINGTON 98144
(206) 284-0860

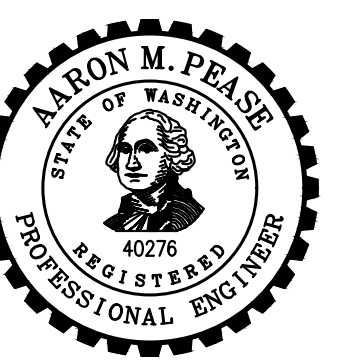

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: <i>ADM</i>		
CHECKED BY: <i>ASB</i>		
DRAWN BY: <i>ASB</i>		
DESIGNER: <i>ADM</i>		
G & O JOB NO.: 21462		
FILE: P6_PLUMB.DWG		



**PLUMBING
AREA 6**

**SECONDARY
SPLITTER BOX AND
RAS/WAS PUMP
STATION PLAN AND
DETAILS**

DRAWING: **P6-2** OF: **2**

GENERAL STRUCTURAL NOTES

GENERAL

THE GENERAL CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND SITE CONDITIONS BEFORE STARTING WORK. THE ENGINEER SHALL BE NOTIFIED OF ANY DISCREPANCY. USE DETAIL MARKED "TYPICAL" WHEREVER APPLICABLE. CHANGES, OMISSIONS OR SUBSTITUTIONS ARE NOT PERMITTED WITHOUT WRITTEN APPROVAL OF THE ENGINEER. REFER TO THE SPECIFICATIONS FOR FURTHER REQUIREMENTS. DO NOT SCALE THE DRAWINGS.

ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE 2018 EDITION OF THE INTERNATIONAL BUILDING CODE.

THE DESIGN, ADEQUACY AND SAFETY OF ERECTION BRACING, SHORING, TEMPORARY SUPPORTS, ETC., IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR, AND HAS NOT BEEN CONSIDERED BY THE ENGINEER OF RECORD. THE CONTRACTOR IS RESPONSIBLE FOR THE STABILITY OF THE STRUCTURE PRIOR TO ITS COMPLETION. THE CONTRACTOR SHALL PROVIDE THE NECESSARY BRACING TO PROVIDE STABILITY PRIOR TO THE COMPLETION OF THE STRUCTURE.

THE GENERAL NOTES APPLY TO ALL STRUCTURES UNLESS NOTED OTHERWISE (U.N.O.). LOCATION AND SIZE OF ANCHOR BOLTS FOR SPECIFIC EQUIPMENT SHALL BE SPECIFIED BY THE VENDOR. CONTRACTOR SHALL COORDINATE LOCATIONS OF STRUCTURAL OPENINGS, PENETRATIONS AND EMBEDDED ITEMS WITH THE MECHANICAL, ARCHITECTURAL, ELECTRICAL, PLUMBING AND VENTILATION SECTIONS OF THE DRAWINGS AND WITH SUPPLIERS AND SUBCONTRACTORS AS MAY BE REQUIRED.

SPECIAL INSPECTION & TESTING

SPECIAL INSPECTIONS SHALL MEET THE REQUIREMENTS OF IBC CHAPTER 17. OBSERVE THE WORK ASSIGNED FOR CONFORMANCE WITH APPROVED DRAWINGS AND SPECIFICATIONS.

FURNISH INSPECTION REPORTS TO THE BUILDING OFFICIAL AND ENGINEER. DISCREPANCIES SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE CONTRACTOR FOR CORRECTION; THEN, IF NOT CORRECTED, TO THE BUILDING OFFICIAL AND ENGINEER. SUBMIT A FINAL REPORT STATING THE WORK WAS IN CONFORMANCE WITH THE APPROVED DRAWINGS AND SPECIFICATIONS AND THE APPLICABLE WORKMANSHIP PROVISIONS OF IBC.

SPECIAL INSPECTION REQUIRED:

STEEL: IN ACCORDANCE WITH SECTION 1705.2 AND TABLE 1705.2.3
 CONCRETE: IN ACCORDANCE WITH SECTION 1705.3 AND TABLE 1705.3
 SOIL: IN ACCORDANCE WITH SECTION 1705.6 AND TABLE 1705.6

ALL WATER CONTAINMENT STRUCTURES SHALL BE TESTED FOR WATER TIGHTNESS. TESTING OF WATER CONTAINMENT STRUCTURES FOR WATER TIGHTNESS SHALL BE PERFORMED IN COMPLIANCE WITH ACI 350.1. THESE STRUCTURES INCLUDE, BUT ARE NOT LIMITED TO SECONDARY CLARIFIER NO. 3

SHOP DRAWINGS

SHOP DRAWINGS, WHERE REQUIRED, SHALL BE CHECKED AND APPROVED BY THE GENERAL CONTRACTOR PRIOR TO SUBMITTING FOR ENGINEER REVIEW. SHOP DRAWINGS SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW OF DESIGN INTENT, PRIOR TO FABRICATION. GENERAL CONTRACTOR IS RESPONSIBLE FOR VERIFICATION AND COORDINATION OF DIMENSIONS AND DETAILS FOR EACH SUBCONTRACTOR.

DESIGN LOADS

GROUND SNOW LOAD, Pg..... 20 PSF

WIND DESIGN DATA:

ULTIMATE WIND SPEED (3-SECOND GUST), Vult..... 105 MPH
 RISK CATEGORY..... III
 WIND EXPOSURE..... C

EARTHQUAKE DESIGN DATA

MAPPED SPECTRAL RESPONSE ACCELERATIONS
 Ss..... 1.287 g
 S1..... 0.443 g
 SITE CLASS..... D
 SPECTRAL RESPONSE COEFFICIENT
 Sds..... 1.030 g
 Sd1..... 0.548 g
 SEISMIC IMPORTANCE FACTOR, Ie..... 1.5
 RISK CATEGORY..... III
 SEISMIC DESIGN CATEGORY..... D

FOUNDATION DATA PER GEOTECHNICAL REPORT BY PanGEO, INC., DATED AUGUST 18, 2021.

ALLOWABLE BEARING PRESSURE.....1500 PSF

ABOVE ARE ASSUMED PER DATA PROVIDED, CONTRACTOR MUST VERIFY IN FIELD.

EXTEND ALL EXTERIOR FOOTINGS 2'-0" MINIMUM BELOW FINISHED GRADE. UNO (UNLESS NOTED OTHERWISE), BOTTOM OF ALL FOOTINGS TO BEAR ON 12" MINIMUM OF PROPERLY COMPACTED CRUSHED SURFACING BASE COURSE (CSBC) OVER NATIVE, INORGANIC, UNDISTURBED SOIL. NO FOOTING SHALL BEAR HIGHER THAN 1 VERTICAL TO 1.5 HORIZONTAL SLOPE ABOVE ANY EXCAVATION, EXISTING OR PLANNED. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING TO PREVENT MOVEMENT OF WALLS IF BACKFILL IS PLACED BEFORE FLOOR SYSTEM IS IN PLACE. THERE SHALL BE 95% COMPACTION (ASTM D1557 MODIFIED PROCTOR DENSITY) OF ALL BACKFILL SOIL UNDER SLABS ON GRADE.

CAST-IN-PLACE CONCRETE

CONCRETE SHALL HAVE THE FOLLOWING PROPERTIES:
 28-DAY STRENGTH f_c=4,000 PSI
 AIR ENTRAINMENT: 5%-7%
 WATER CONTAINMENT STRUCTURES: f_c=4,000 PSI @ 28 DAYS
 MAXIMUM SLUMP: 3" FOR SLABS FOOTINGS, 4" FOR WALLS, COLUMNS AND BEAMS. CONSTRUCTION TO BE IN ACCORDANCE WITH ACI 318.

SUBMIT MIX DESIGN FOR REVIEW AND PROVIDE NOT LESS THAN 6 SACKS OF CEMENT PER CUBIC YARD FOR ALL CONCRETE WITH MAXIMUM W/C=0.45.

REINFORCING STEEL

WELDED WIRE FABRIC (W.W.F.): ASTM A82 AND A185
 DEFORMED BARS: ASTM A615, GRADE 60 (GRADE 40 FOR #3). UNLESS OTHERWISE NOTED ON THESE DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING BARS SHALL BE AS FOLLOWS:
 CONCRETE CAST AGAINST SOIL=3".
 FORMED CONCRETE AGAINST SOIL=2".
 WALLS, COLUMNS AND BEAMS EXPOSED TO WATER, SEWAGE & WEATHER=2".
 WALLS, COLUMNS AND BEAMS DRY CONDITION=1 1/2".

PROVIDE 2-#5 MIN. U.N.O. TRIM BARS AROUND ALL OPENINGS IN CONCRETE WALLS OR SLAB EXTENDING 2'-6" PAST CORNERS, TYP. AT TIME OF CONCRETE PLACEMENT, REINFORCING SHALL BE FREE OF MUD, OIL, OR OTHER NONMETALLIC COATINGS THAT MAY DECREASE BOND.

WELDING OF REINFORCING BARS SHALL CONFORM TO ANSI/AWS D1.4.

WHERE PERMITTED, LOW HYDROGEN WELDING RODS SHALL BE USED FOR ALL WELDING OF REINFORCING BARS. SPECIAL INSPECTION IS REQUIRED FOR ALL FIELD WELDING.

SUBMIT SHOP DRAWINGS OF REINFORCING STEEL FOR REVIEW BY THE ENGINEER PRIOR TO FABRICATION. REINFORCING SHALL BE DETAILED IN ACCORDANCE WITH ACI 315 AND 318 (LATEST EDITION).

STRUCTURAL STEEL AND MISCELLANEOUS METALS

"W" SHAPES: ASTM A992, Fy=50 KSI.
 CHANNELS, ANGLES, PLATES, AND BARS: ASTM A36, Fy=36 KSI.
 PIPE: ASTM A53 OR A501, Fy=35 KSI MINIMUM.
 TUBING: ASTM A500, GRADE B, Fy=46 KSI.


ALL BOLTS FOR CONNECTIONS IN SUBMERGED CONDITION SHALL BE: ASTM F593C OR F593D STAINLESS STEEL (SS) BOLTS. ALL OTHERS SHALL BE GALVANIZED ASTM A325-N BOLTS HIGH STRENGTH BOLTS (H.S.B.), U.N.O. AS ASTM A307 MACHINE BOLTS (M.B.). WHERE HIGH STRENGTH BOLTS ARE USED, THEY SHALL BE INSTALLED WITH LOAD INDICATOR DEVICES (LOAD INDICATOR WASHERS OR SNAP-OFF HEADS).
 ADHESIVE ANCHORS: HILTI HIT-RE 500 V3 OR APPROVED EQUAL, U.N.O. INSTALL PER MANUFACTURER'S RECOMMENDATIONS.

HEADED ANCHOR STUDS (H.A.S.): ASTM A108, Fy=50 KSI, END WELDED PER MANUFACTURER'S RECOMMENDATIONS.
 ALL ANCHOR BOLTS AND THREADED RODS: ASTM F1554, U.N.O. ALL ANCHOR BOLTS MUST BE ACCURATELY PLACED IN THEIR FINAL LOCATION PRIOR TO POURING CONCRETE, "WET STICKING" OF ANCHOR BOLTS IS NOT ALLOWED.

WELDING ELECTRODES OR WIRES: AWS A5.1 OR A5.5, E70XX; AWS A5.17, E70S-X; AWS A5.20, E7XT-X.
 FOR ALL SHOP WELDS AND FIELD WELDS OF ALL LATERAL RESISTING ELEMENTS, ELECTRODES SHALL BE E70 WITH A MINIMUM SPECIFIED CVN OF 20 FT-LBS AT -20 DEGREES FAHRENHEIT. ALL WELDS SHALL BE 3/16" MINIMUM U.N.O.

ERECTION AND FABRICATION IN ACCORDANCE WITH AISC "SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS." WELDING SHALL CONFORM TO AWS "STRUCTURAL WELDING CODE - STEEL". ALL WELDING SHALL BE PERFORMED BY AWS/WABO CERTIFIED WELDERS.

ALL COLUMNS AND BEAMS TO BE FROM UNSPLICED LENGTHS U.N.O. ON THE DRAWINGS. SUBMIT SHOP DRAWINGS SHOWING SIZES, DIMENSIONS AND REQUIRED CONNECTION DETAILS FOR REVIEW BY THE ENGINEER PRIOR TO FABRICATION.

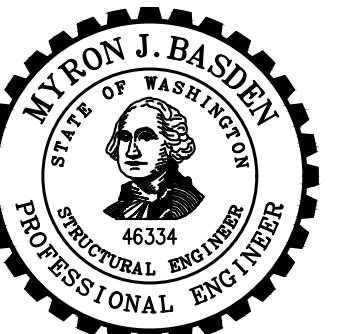

CITY OF PUYALLUP
WATER POLLUTION CONTROL PLANT THIRD SECONDARY CLARIFIER
CIP NO. 20-018
 1602 18TH ST NW,
 PUYALLUP, WA 98371

PRELIMINARY NOT FOR CONSTRUCTION

No.	DATE	REVISION

ISSUED FOR: 90% DESIGN REVIEW

ISSUE DATE: DECEMBER 2021

APPROVED BY: MJB


CHECKED BY: AQ

DRAWN BY: RAH

DESIGNER: MJB

G & O JOB NO.: 21462

FILE: S_STND.DWG

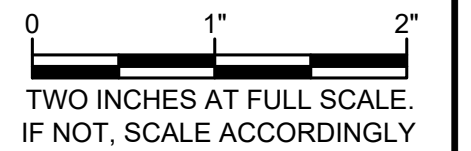

STRUCTURAL

APPROVED
 BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP
 APPROVED
 DATE: _____
 EXPIRATION
 DATE: _____
 NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
 The City will not be responsible for errors and/or omissions on these plans.
 Field conditions may dictate changes to these plans as determined by the City Engineer.

GENERAL STRUCTURAL NOTES

DRAWING: **S-1** OF: **3**


SPECIAL INSPECTION SCHEDULE

VERIFICATION AND INSPECTION	CI	PI	REMARKS/REFERENCES
CONCRETE:			
REINFORCING STEEL INCLUDING PLACEMENT	-	X	ACI 318: CH 20, 25.2, 25.3, 26.6.1-26.6.3
ANCHOR RODS, EMBEDDED BOLTS AND INSERTS	X	-	PRIOR TO AND DURING PLACEMENT OF CONCRETE
USE OF REQUIRED DESIGN MIX	-	X	ACI 318: CH. 19, 26.4.3, 26.4.4
CONCRETE SLUMP, AIR CONTENT, TEMPERATURE AND TEST SPECIMENS	X	-	WHILE MAKING SPECIMENS FOR STRENGTH TESTS
CONCRETE AND SHOTCRETE PLACEMENT	X	-	ACI 318: 26.5
CONCRETE CURING	-	X	ACI 318: 26.5.3-26.5.5
CONCRETE FORMWORK FOR SHAPE, LOCATIONS AND DIMENSIONS	-	X	ACI 318: 26.11.1.2(6)
STEEL:			
MATERIAL VERIFICATION OF HIGH-STRENGTH BOLTS, NUTS AND WASHERS:			
MANUFACTURER'S CERTIFICATE	-	X	
INSPECTION OF HIGH-STRENGTH BOLTING:	-	X	AISC 360, SECTION N5.6
MATERIAL VERIFICATION OF STRUCTURAL STEEL AND COLD	-	X	
IDENTIFICATION MARKINGS TO CONFORM TO ASTM STANDARDS SPECIFIED IN THE APPROVED CONSTRUCTION DOCUMENTS	-	X	AISC 360, N5.7
INSPECTION OF WELDING:			
COMPLETE AND PARTIAL PENETRATION GROOVE WELDS	X	-	AWS D1.1
MULTIPASS, SINGLE-PASS FILLET WELDS > 5/16", PLUG AND SLOT WELDS	X	-	AWS D1.1
SINGLE-PASS FILLET WELDS < 5/16", FLOOR AND ROOF DECK WELDS	-	X	AWS D1.3
REINFORCING STEEL	X	-	AWS D1.4, ACI 318: SECTION 26.6.4
SOILS:			
VERIFY DESIGN BEARING CAPACITY	-	X	
VERIFY EXCAVATIONS	-	X	
CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIALS	-	X	
USE OF MATERIALS, DENSITIES AND LIFT THICKNESSES	X	-	DURING PLACEMENT AND COMPACTION
OBSERVE SUBGRADE AND SITE PREPARED PROPERLY	-	X	PRIOR TO PLACEMENT OF COMPACTED FILL

SUPPLEMENTAL STRUCTURAL ABBREVIATIONS:

ABV ABOVE	FND FOUNDATION	STRUC STRUCTURE(AL)
AFF ABOVE FINISH FLOOR	FO FACE OF	SYM SYMMETRICAL
ADD'L ADDITIONAL	FS FAR SIDE	TOP TOP
ADJ ADJACENT	FTG FOOTING	TEMPORARY TEMPORARY
AL ALUMINUM	GA GAUGE	TO TOP OF
APPRX APPROXIMATE	HAS HEADER ANCHOR STUDS	TOS TOP OF SLAB
@ AT	HDR HEADER	TRANS TRANSVERSE
BEL BELOW	HGR HANGER	TYP TYPICAL
BM BEAM	HSB HIGH STRENGTH BOLT (A325 UNO)	UNO UNLESS NOTED OTHERWISE
BNDRY BOUNDARY	HSS HOLLOW STRUCTURAL STEEL	VERIFY VERIFIED
BO BOTTOM OF	IBC INTERNATIONAL BUILDING CODE	WHS WELDED HEADED STUD
BOS BOTTOM OF SLAB	IF INTERIOR	WP WORK POINT
BOT BOTTOM	INT INTERIOR	WTS WELDED THREADED STUD
BRG BEARING	K KIPS (1000 POUNDS)	X-STG EXTRA STRONG
CANT CANTILEVER(ED)	LAT LATERAL	XX-STG DOUBLE EXTRA STRONG
CDF CONTROLLED DENSITY FILL	LDGR LEDGER	
CG CENTER OF GRAVITY	LLH LONG LEG HORIZONTAL	
CIP CAST IN PLACE	LLV LONG LEG VERTICAL	
CJ CONTROL JOINT	LS LAG SCREW	
CJP COMPLETE JOINT PENETRATION	MAT'L MATERIAL	
COL COLUMN	MB MACHINE BOLT (A307)	
CONST CONSTRUCTION	MFR MANUFACTURER	
CONT CONTINUOUS	MTL METAL	
CTSK COUNTERSINK	(N) NEW MEMBER	
D DEPTH	NS NEAR SIDE	
DBL DOUBLE	OH OVERHANG	
DIAG DIAGONAL	ORNT ORIENTATE (ION)	
DIAPH DIAPHRAGM	PAR PARALLEL	
do DITTO (DO OVER)	PERP PERPENDICULAR	
DWG DRAWING	PT PRESSURE TREAT(ED)	
DWL DOWEL	QTY QUANTITY	
EA EACH	REF REFERENCE	
EF EACH FACE	REINF REINFORCEMENT	
EJ EXPANSION JOINT	SHT SHEET	
EMBD EMBED(MENT)	SIM SIMILAR	
ENG ENGINEER	SKW SKEW(ED)	
EQ EQUAL	SPC SPACING	
ES EACH SIDE	SS STAINLESS STEEL	
EXIST EXISTING MEMBER	STGR STAGGER	
EXT EXTERIOR	STIFF STIFFENER	
FFE FINISHED FLOOR ELEVATION	STIRR STIRRUP	

STRUCTURAL LEGEND

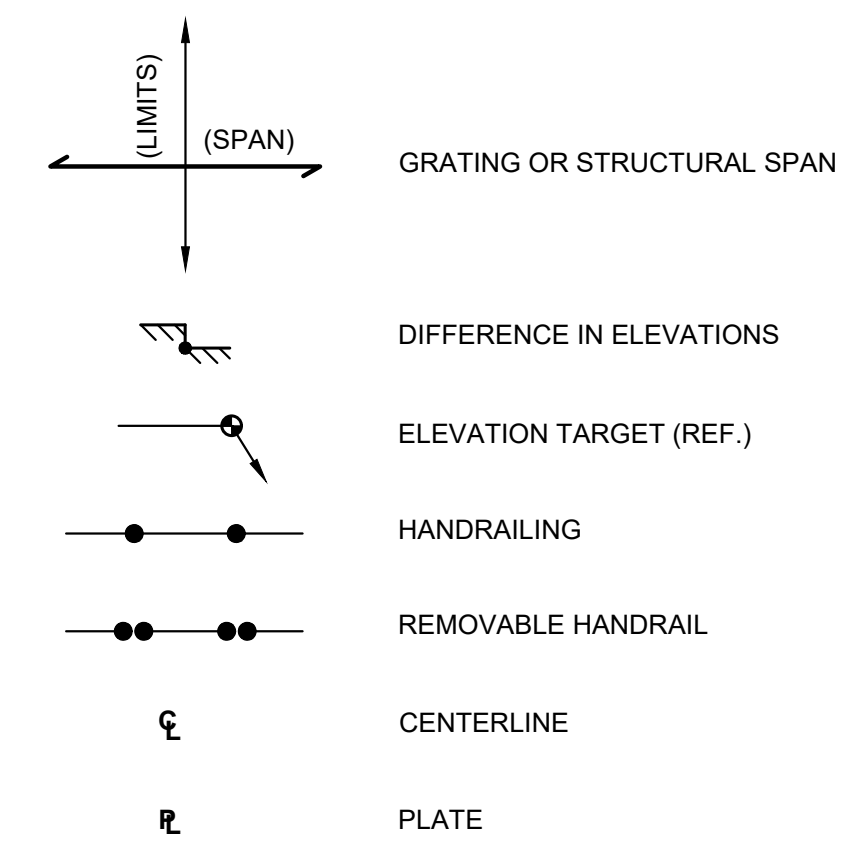

Gray & Osborne, Inc.
CONSULTING ENGINEERS
1130 RAINIER AVENUE SOUTH,
SUITE 300
SEATTLE, WASHINGTON 98144
(206) 284-0860




CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION


ISSUED FOR:
90% DESIGN REVIEW
ISSUE DATE: DECEMBER 2021
APPROVED BY: MJB
CHECKED BY: AQ
DRAWN BY: RAH
DESIGNER: MJB
G & O JOB NO.: 21462
FILE: S_STND.DWG




**STRUCTURAL
SPECIAL INSPECTION
SCHEDULE,
SUPPLEMENTAL
STRUCTURAL
ABBREVIATIONS,
STRUCTURAL LEGEND
AND TYPICAL DETAILS**

DRAWING: **S-2** OF: **3**


- INSPECTION SCHEDULE NOTES**
- ITEMS MARKED WITH AN "X" REQUIRE INSPECTION BY A SPECIAL INSPECTOR APPROVED BY THE BUILDING OFFICIAL.
 - ITEMS MARKED "NA" ARE NOT APPLICABLE TO THIS PROJECT.
 - CI = CONTINUOUS INSPECTION DURING PROGRESS OF WORK BY SPECIAL INSPECTOR.
 - PI = PERIODIC INSPECTION BY SPECIAL INSPECTOR AS REQUIRED TO CONFIRM CONFORMANCE OF WORK.
 - TESTING AND INSPECTION REPORTS SHALL BE SUBMITTED TO THE ENGINEER, BUILDING OFFICIAL AND CONTRACTOR.
 - OWNER WILL CONTRACT FOR SPECIAL INSPECTION SERVICES.

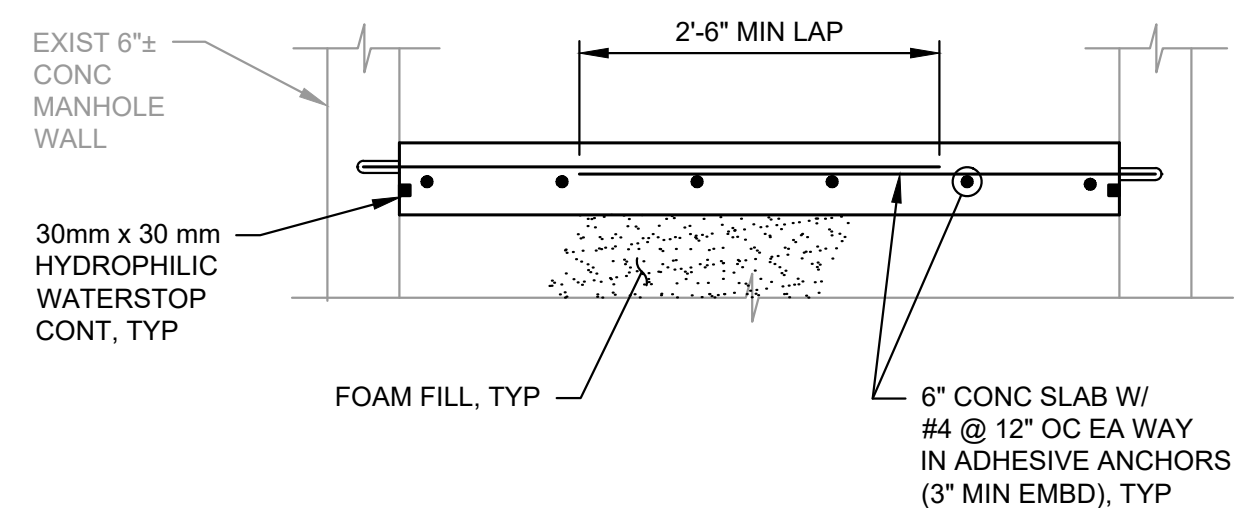

1
**TYPICAL SLAB INFILL
IN EXISTING MANHOLE**
SCALE: 3/4"=1'-0"

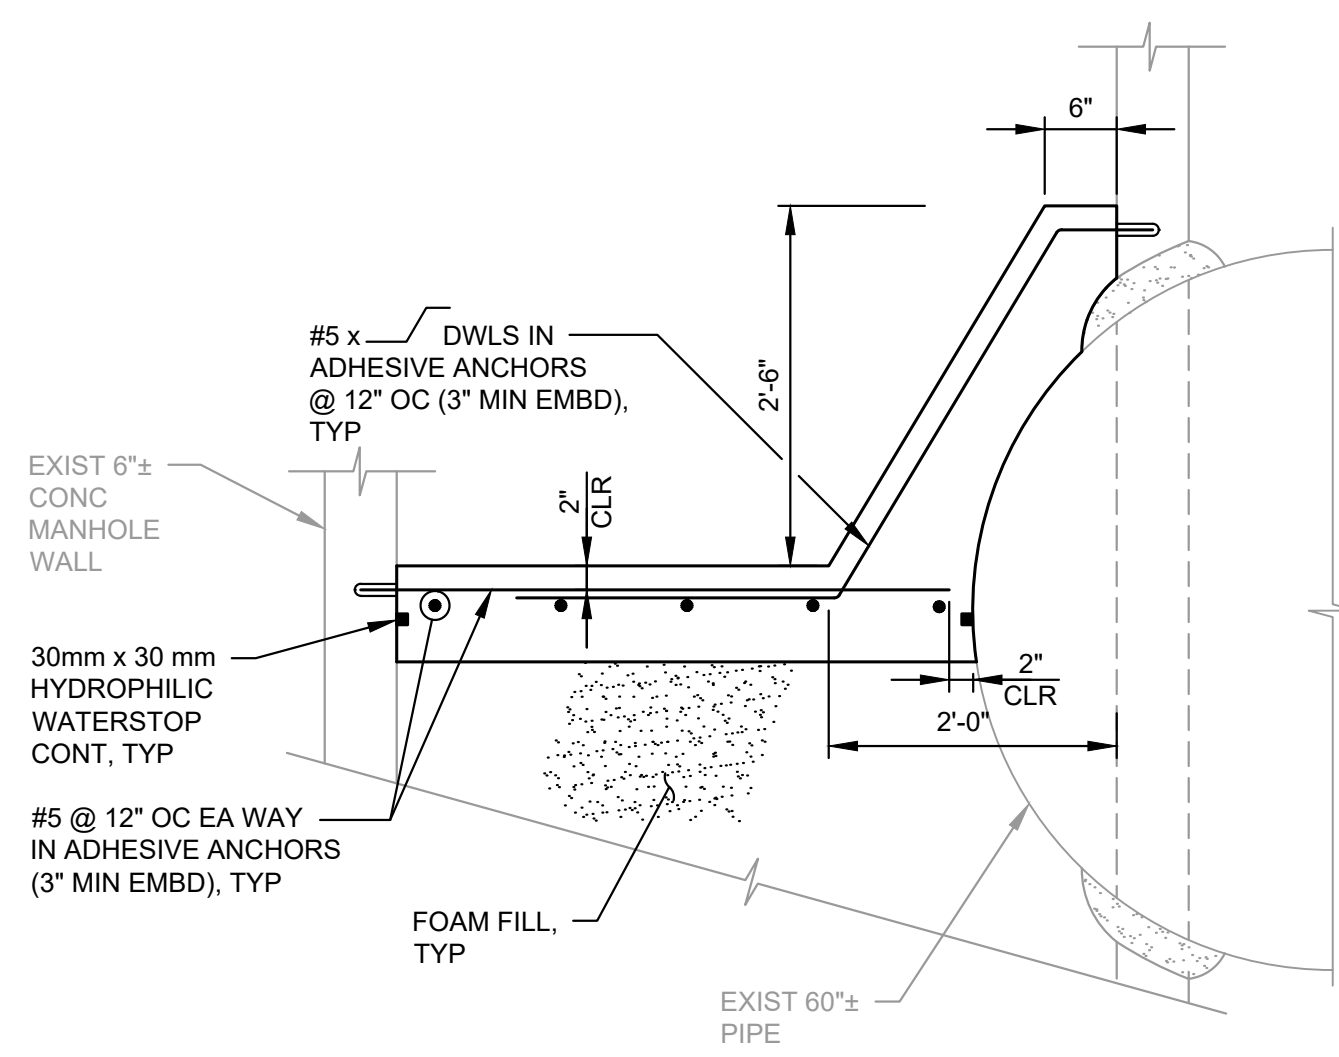

2
**MODIFIED SLAB INFILL
IN EXISTING MANHOLE**
SCALE: 3/4"=1'-0"

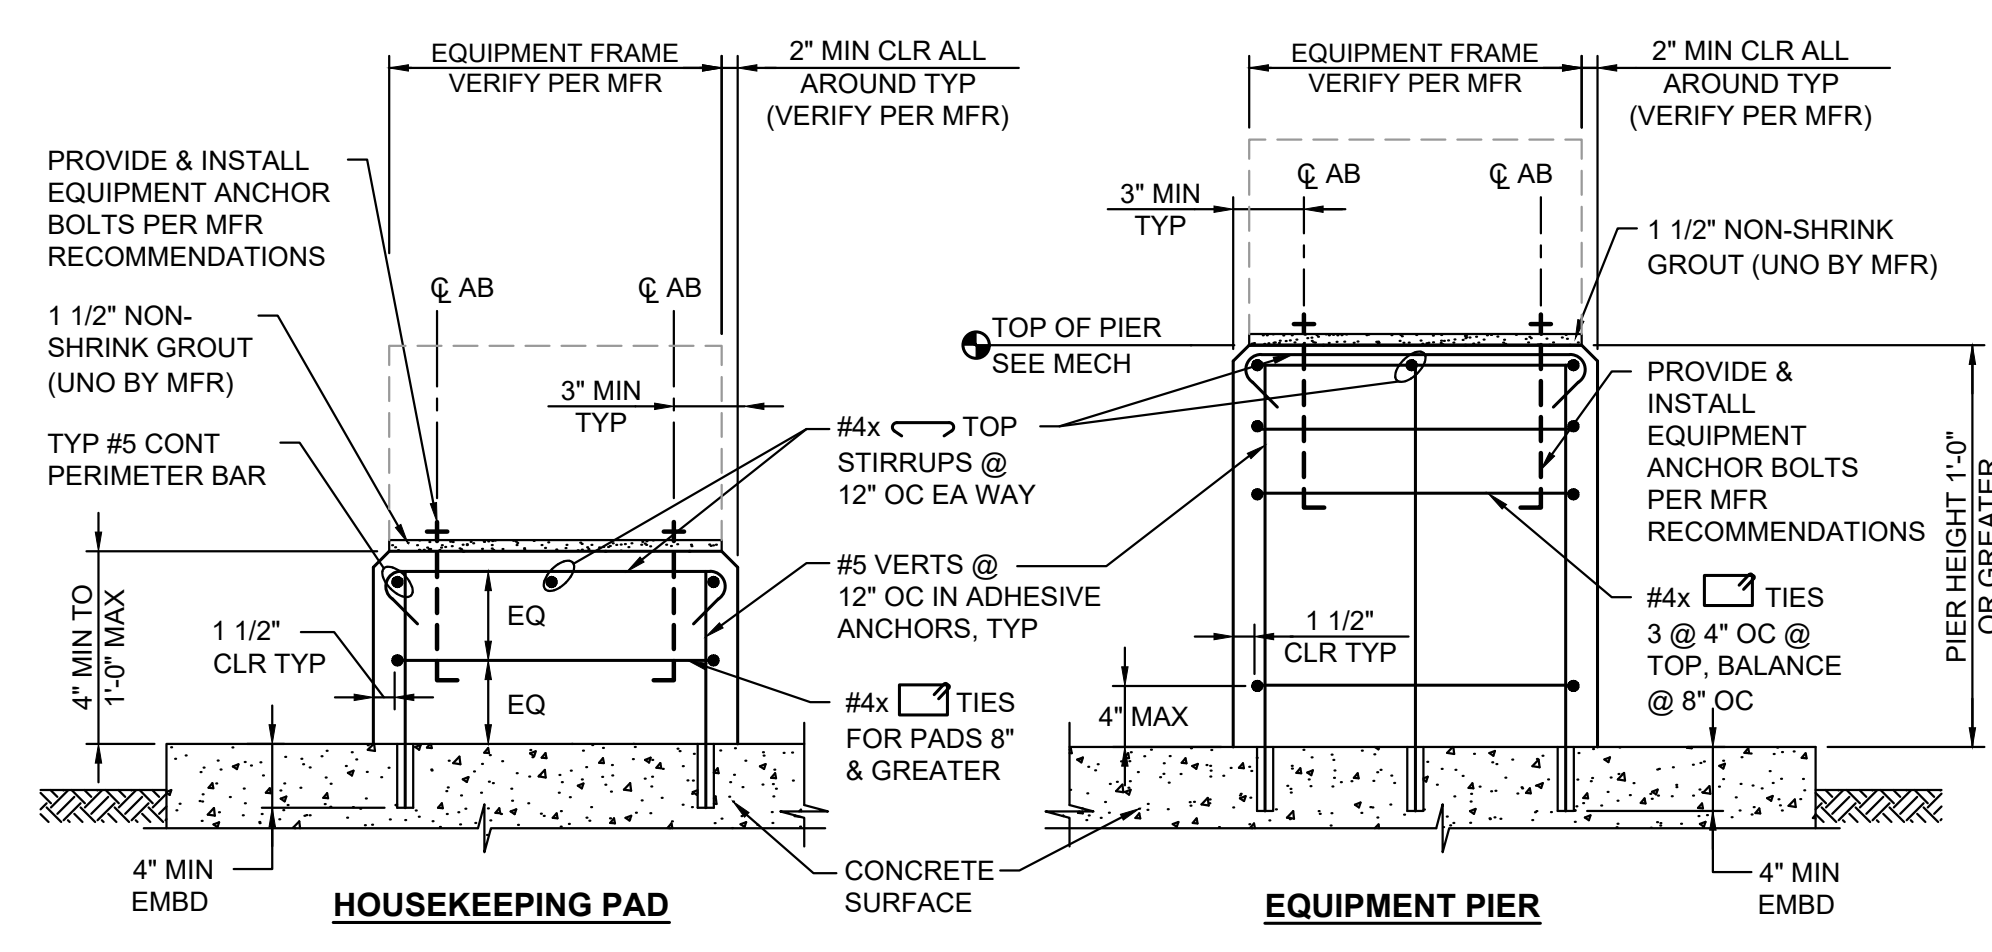


3
**TYP HOUSEKEEPING PAD
& EQUIPMENT PIER DETAILS**
NOT TO SCALE

- NOTES:**
- CHAMFER ALL EXPOSED CORNERS OF HOUSEKEEPING PADS AND EQUIPMENT PIERS.
 - FOR PIER HEIGHT LESS THAN 1'-0" SEE HOUSEKEEPING PAD DETAIL


APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED DATE: _____
EXPIRATION DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

m:\PUYALLUP\21462\wpcp\3rd_secondary\clarifier01_design\PlanSet\Structural\S_STND.dwg, 1/3/2022 2:39 PM, CHARLEY REID

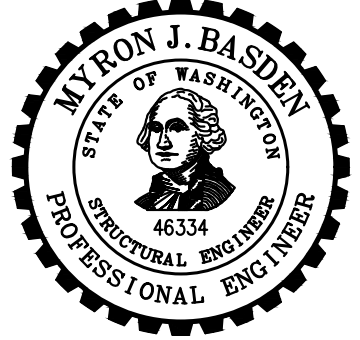

**PRELIMINARY
NOT FOR
CONSTRUCTION**


No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: MJB		
CHECKED BY: AQ		
DRAWN BY: RAH		
DESIGNER: MJB		
G & O JOB NO.: 21462		
FILE: S_STND.DWG		



STRUCTURAL


**TYPICAL
STRUCTURAL
DETAILS**

BOLT DIA. "D"	MINIMUM EMBEDMENT	
	ANCHOR BOLTS IN HORIZ SURFACE	ANCHOR BOLTS IN VERT SURFACE
1/2"	8"	7"
5/8"	8"	7"
3/4"	12"	7"
7/8"	12"	8"
1"	14"	9"
1 1/8"	14"	10"

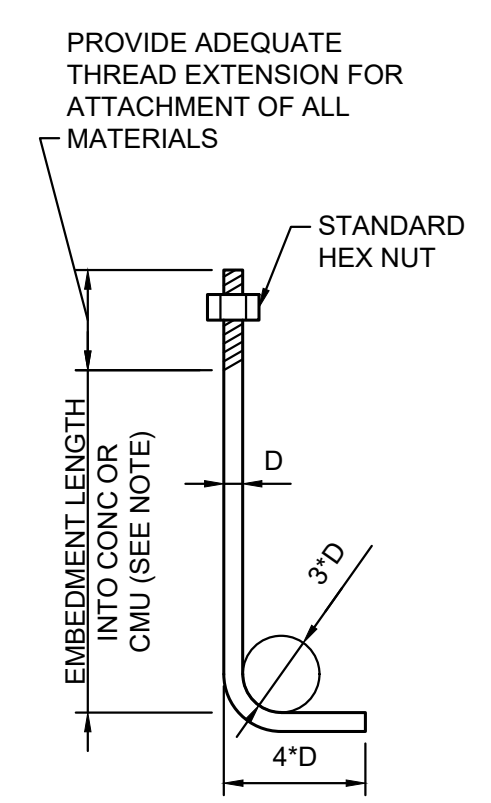

NOTE:
ANCHOR BOLT EMBEDMENT IN VERTICAL SURFACE APPLIES TO CONCRETE ONLY.

4 TYP ANCHOR BOLT DETAIL
TYP NOT TO SCALE

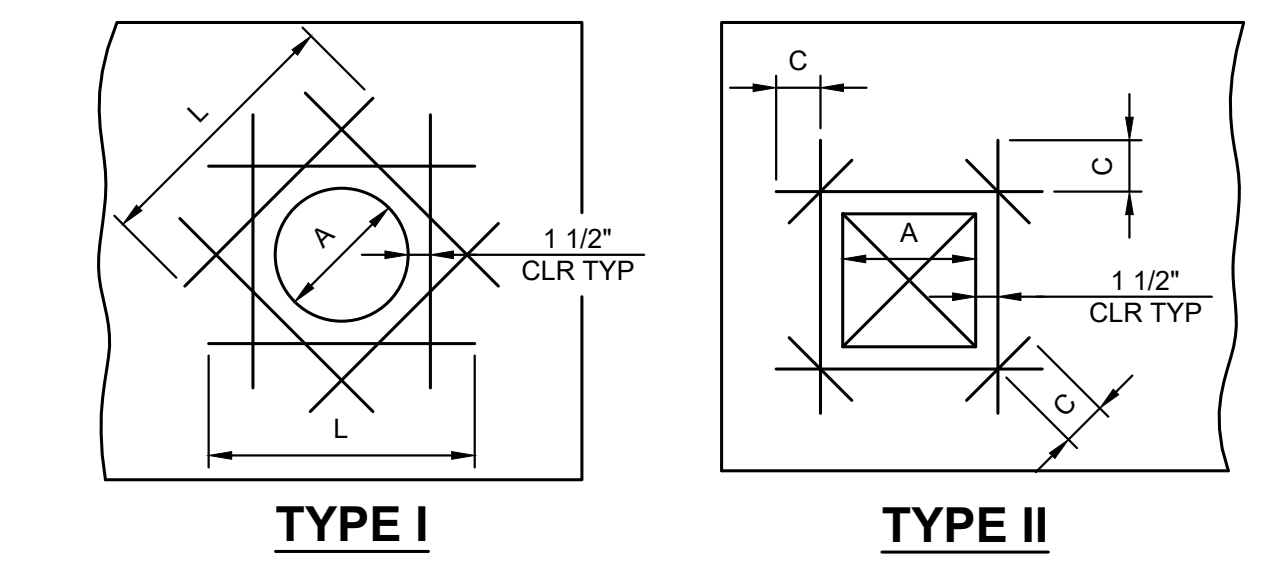


OPENING SIZE (A)	TYPE I		TYPE II	
	MINIMUM BAR LENGTH (L)	BAR SIZE	(C)	BAR SIZE
0" - 12"	3' - 9"	#5	1' - 0"	MATCH VERTICAL BARS OR LARGEST BAR IN SLABS OR WALKWAYS
13" - 18"	4' - 9"	#6	1' - 3"	
19" - 24"	6' - 9"	MATCH VERTICAL BARS OR LARGEST BAR IN SLABS OR WALKWAYS	2' - 6"	
25" - 36"	7' - 9"		2' - 6"	
36"	8' - 9"		2' - 6"	

NOTE:
ALL BARS, EACH FACE. USE THESE BAR SIZES UNLESS OTHERWISE NOTED.


3 TYP PENETRATION REINFORCING DETAIL
TYP NOT TO SCALE

REINF	LAP
#4	2'-4"
#5	3'-0"
#6	3'-6"
#7	4'-3"
#8	4'-10"
#9	5'-3"
#10	6'-6"
#11	8'-0"

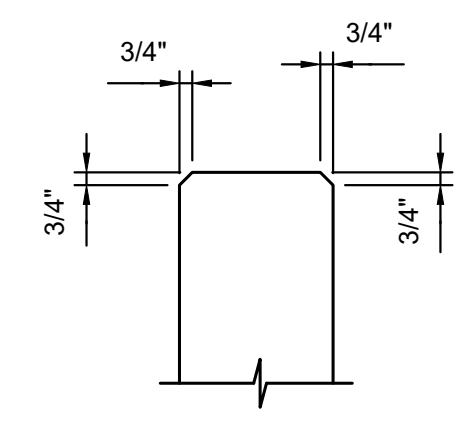

2 TYP CHAMFER DETAIL
TYP NOT TO SCALE


1 TYP LAP SCHEDULE
TYP NOT TO SCALE

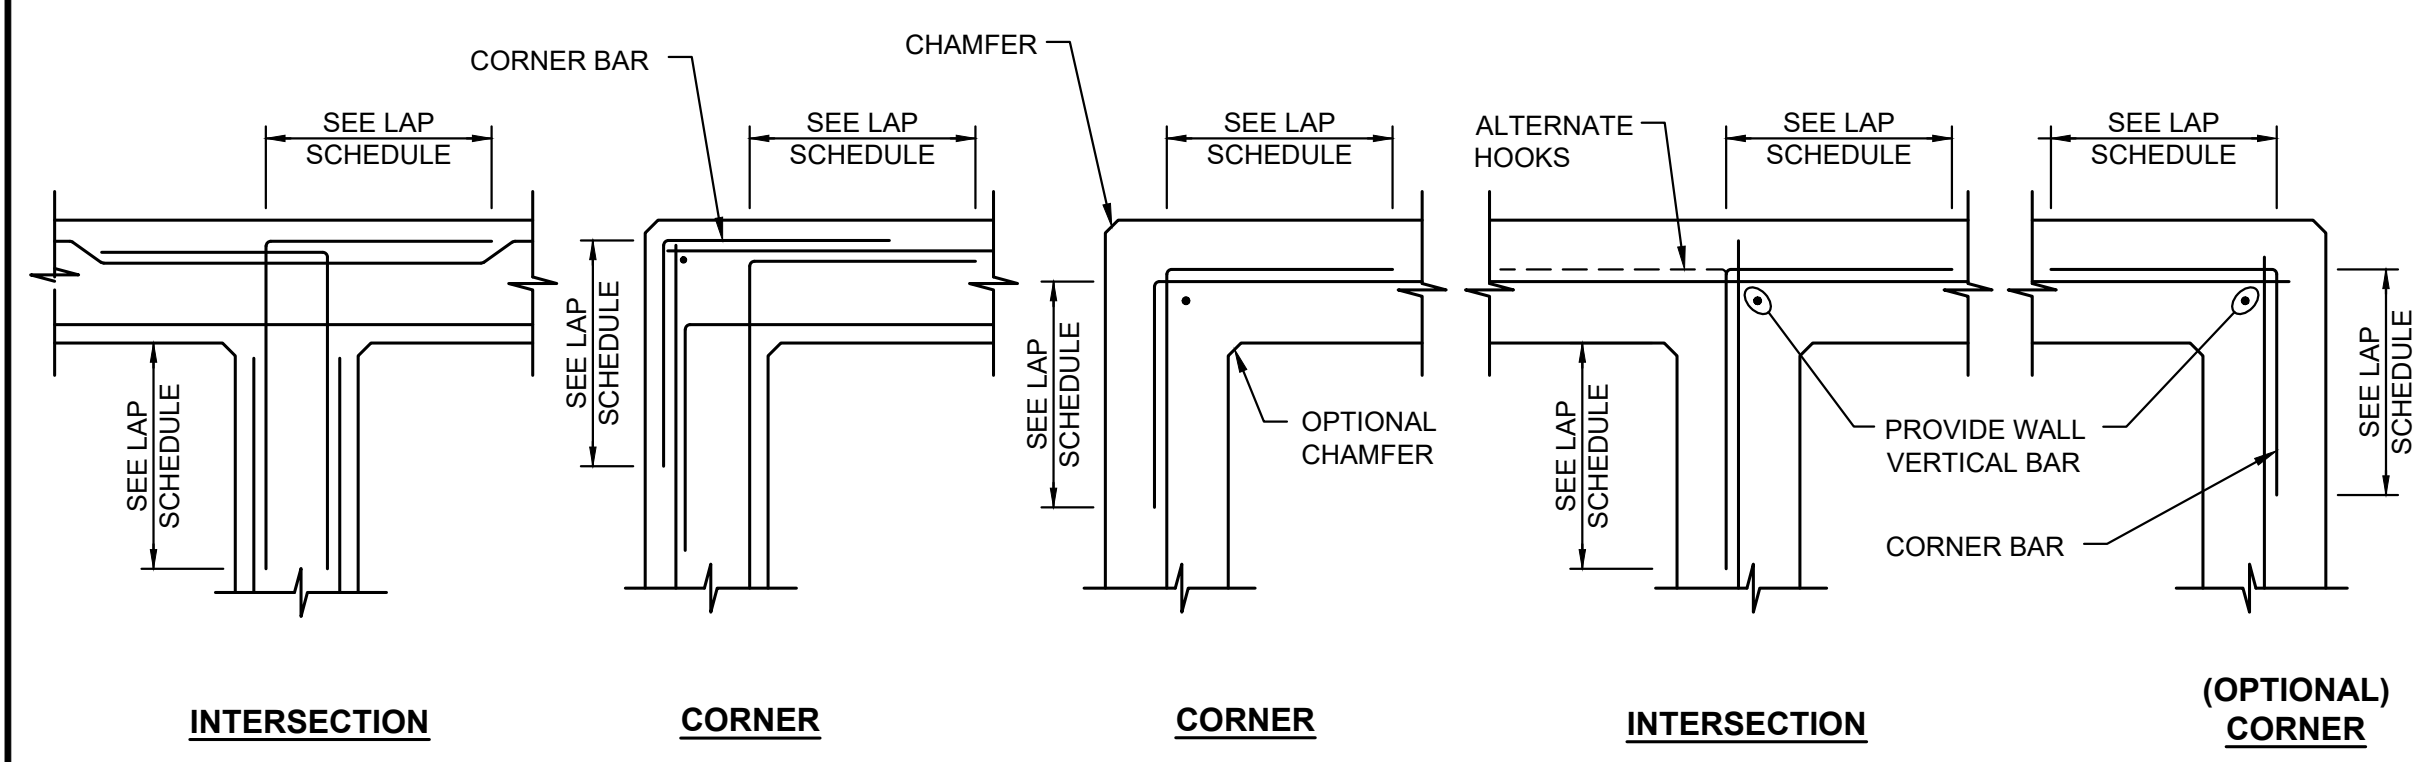

DOUBLE CURTAIN


SINGLE CURTAIN

5 TYP REINFORCING @ WALL INTERSECTION DETAIL
TYP NOT TO SCALE

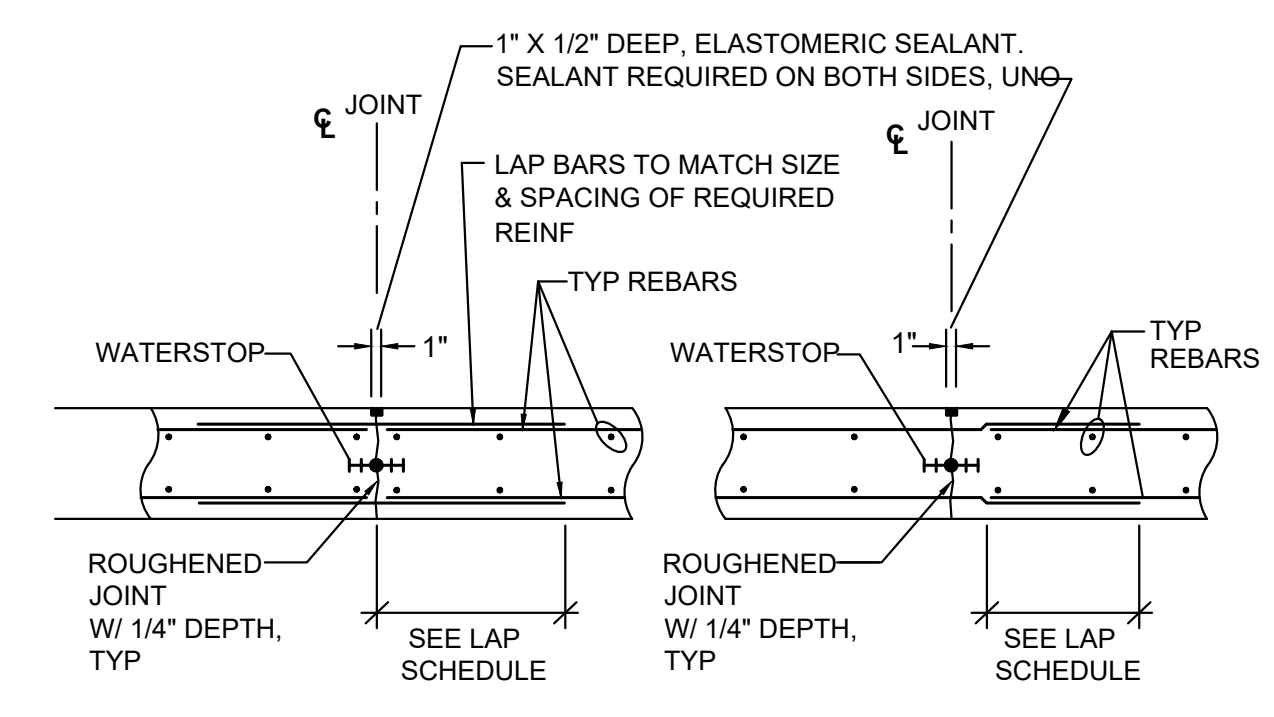


NOTE:
1. FOR SINGLE CURTAIN REINFORCING LOCATE REINFORCING AT CENTER OF WALL & WATER STOP ON DRY SIDE OF WALL.
2. WATERSTOP REQUIRED FOR ALL WATER CONTAINMENT STRUCTURES.

6 TYP CONSTRUCTION CONTROL JOINT (C.C.J.) DETAIL
TYP NOT TO SCALE

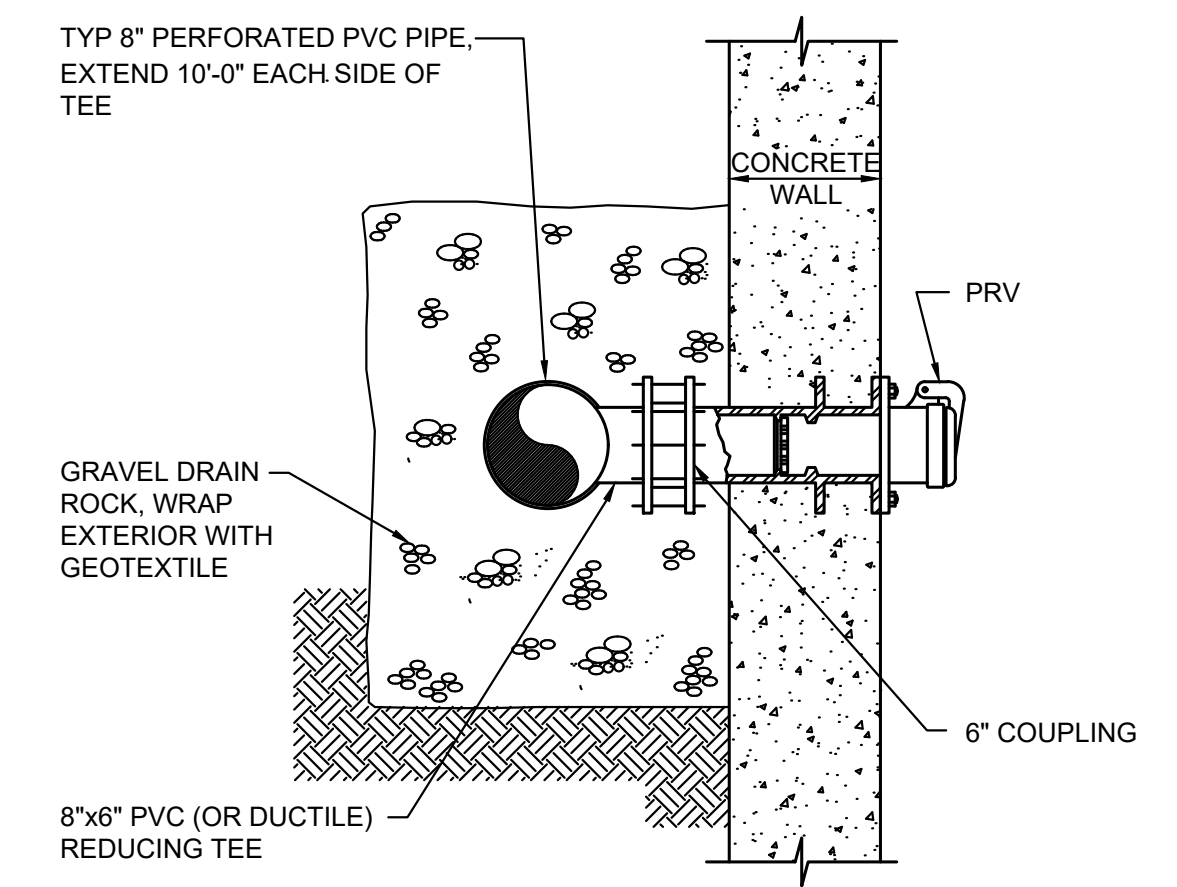


CONCRETE WALLS

7 TYP HYDROSTATIC PRESSURE RELIEF VALVE (PRV) DETAIL
TYP NOT TO SCALE

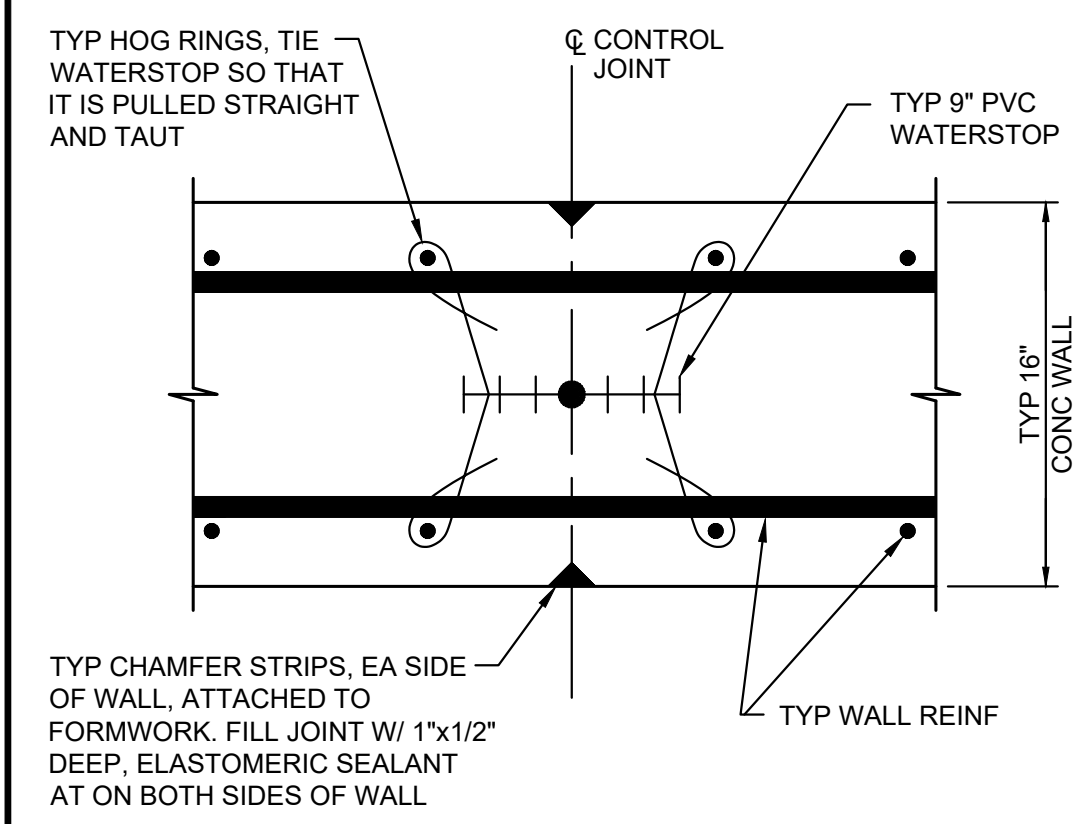


WATER STOP @ WALL


8 TYP WATERSTOP INSTALLATION DETAIL
TYP NOT TO SCALE

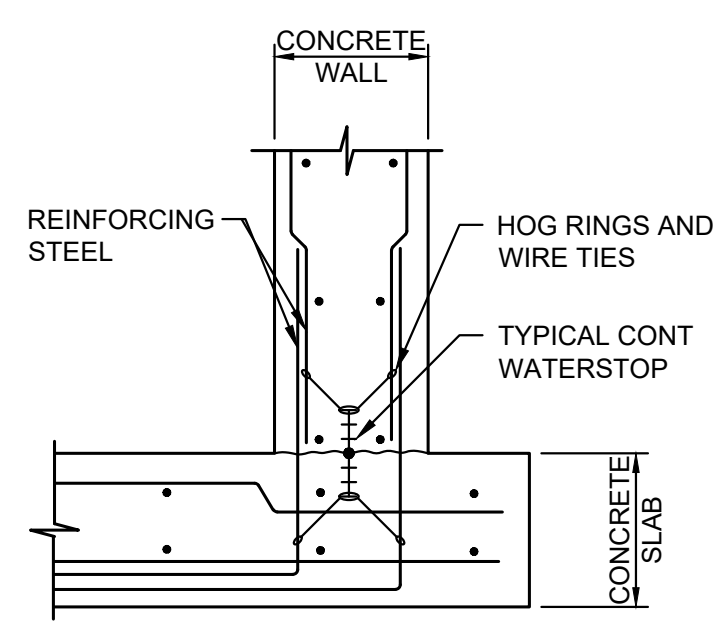

WATER STOP @ SLAB

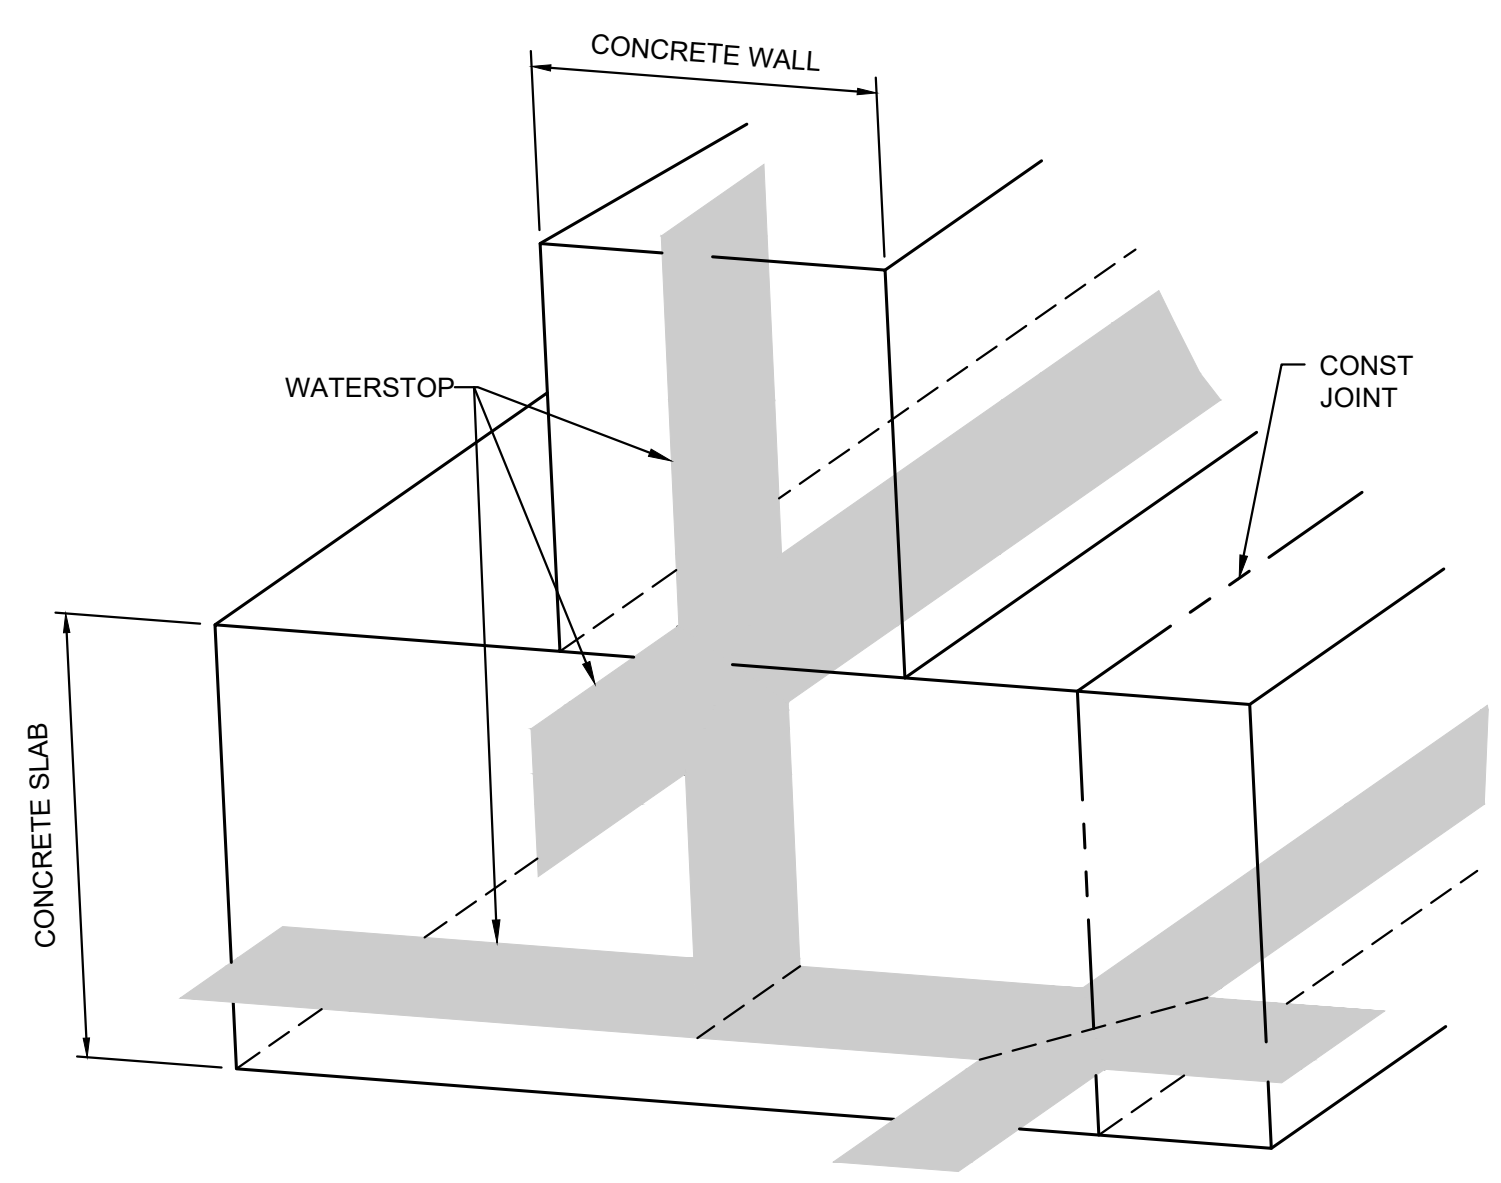


TYP WATER STOP PLACEMENT

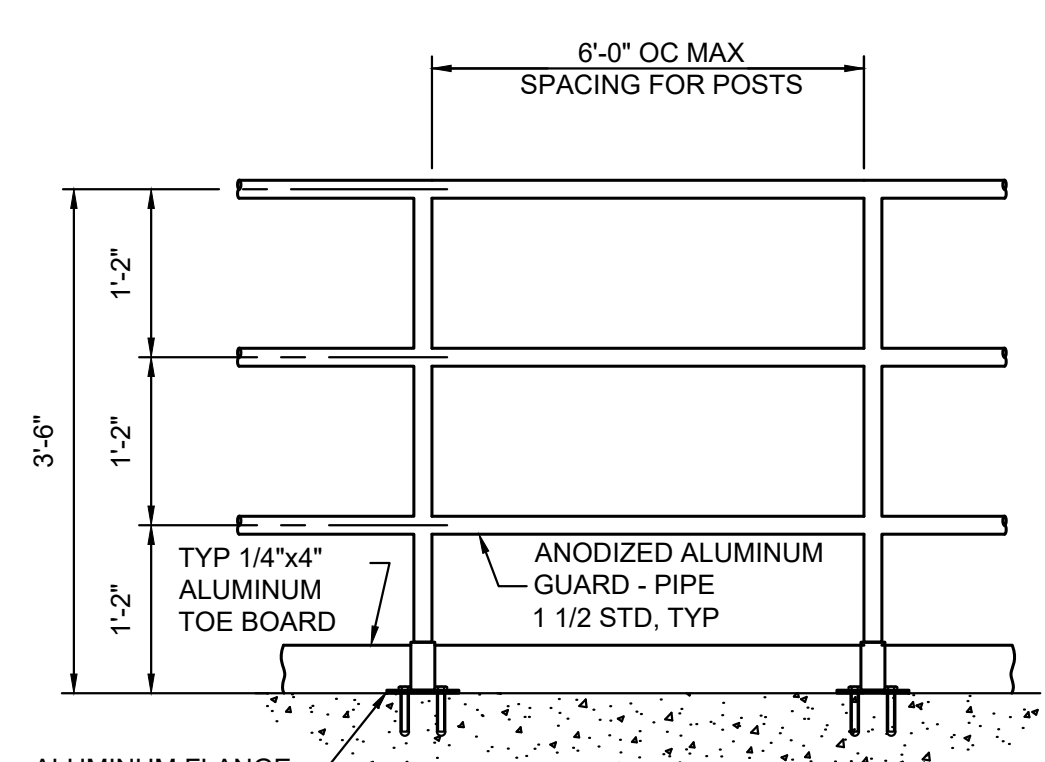

ALUMINUM FLANGE BASE ASSEMBLY AT REMOVABLE GUARD. SEE DETAIL.

NOTES:
1. CONTRACTOR SHALL PROVIDE GUARD CONNECTIONS CAPABLE OF RESISTING REACTIONS DUE TO LATERAL LOADS AS REQ'D BY IBC.

9 GUARD MOUNTING DETAIL
TYP SCALE: 3/4"=1'-0"


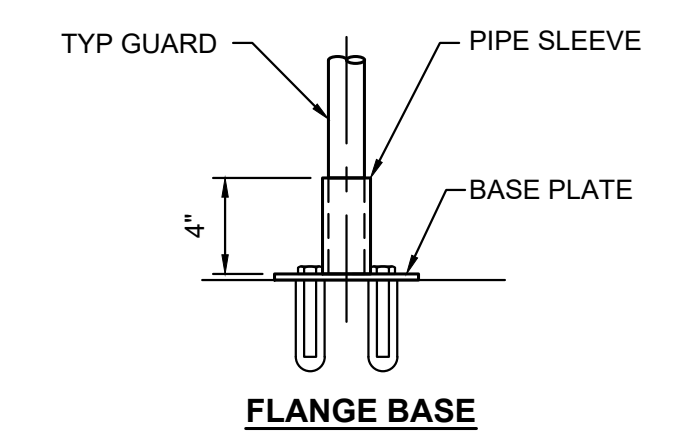


BASES AT REMOVABLE GUARDS

APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED DATE: _____
EXPIRATION DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

m:\PUYALLUP\21462\wpcp\3rd\secondary clarifier\01 design\Plans\Structural\S_STND.dwg, 1/3/2022 2:39 PM, CHARLEY REID

m:\PUYALLUP\21462\wpcp\3rd\secondary clarifier01\design\PlanSet\Structural\7_SC3_PLN.dwg, 1/3/2022 2:39 PM, CHARLEY REID

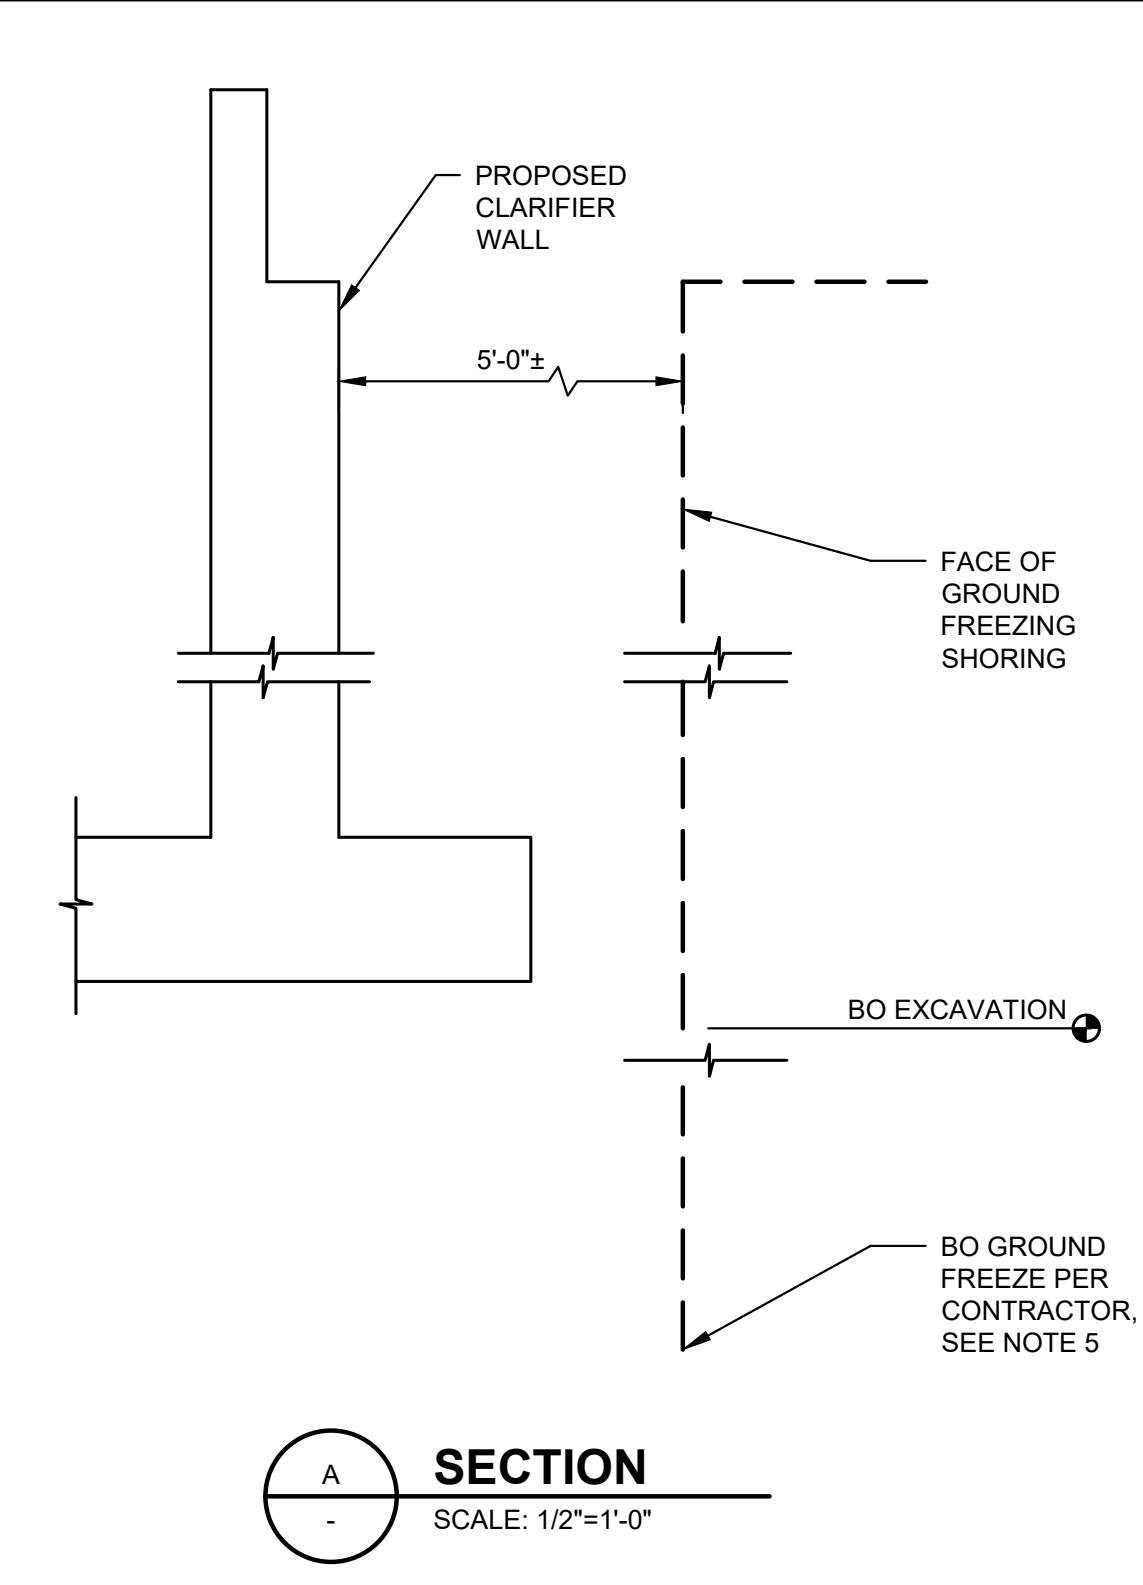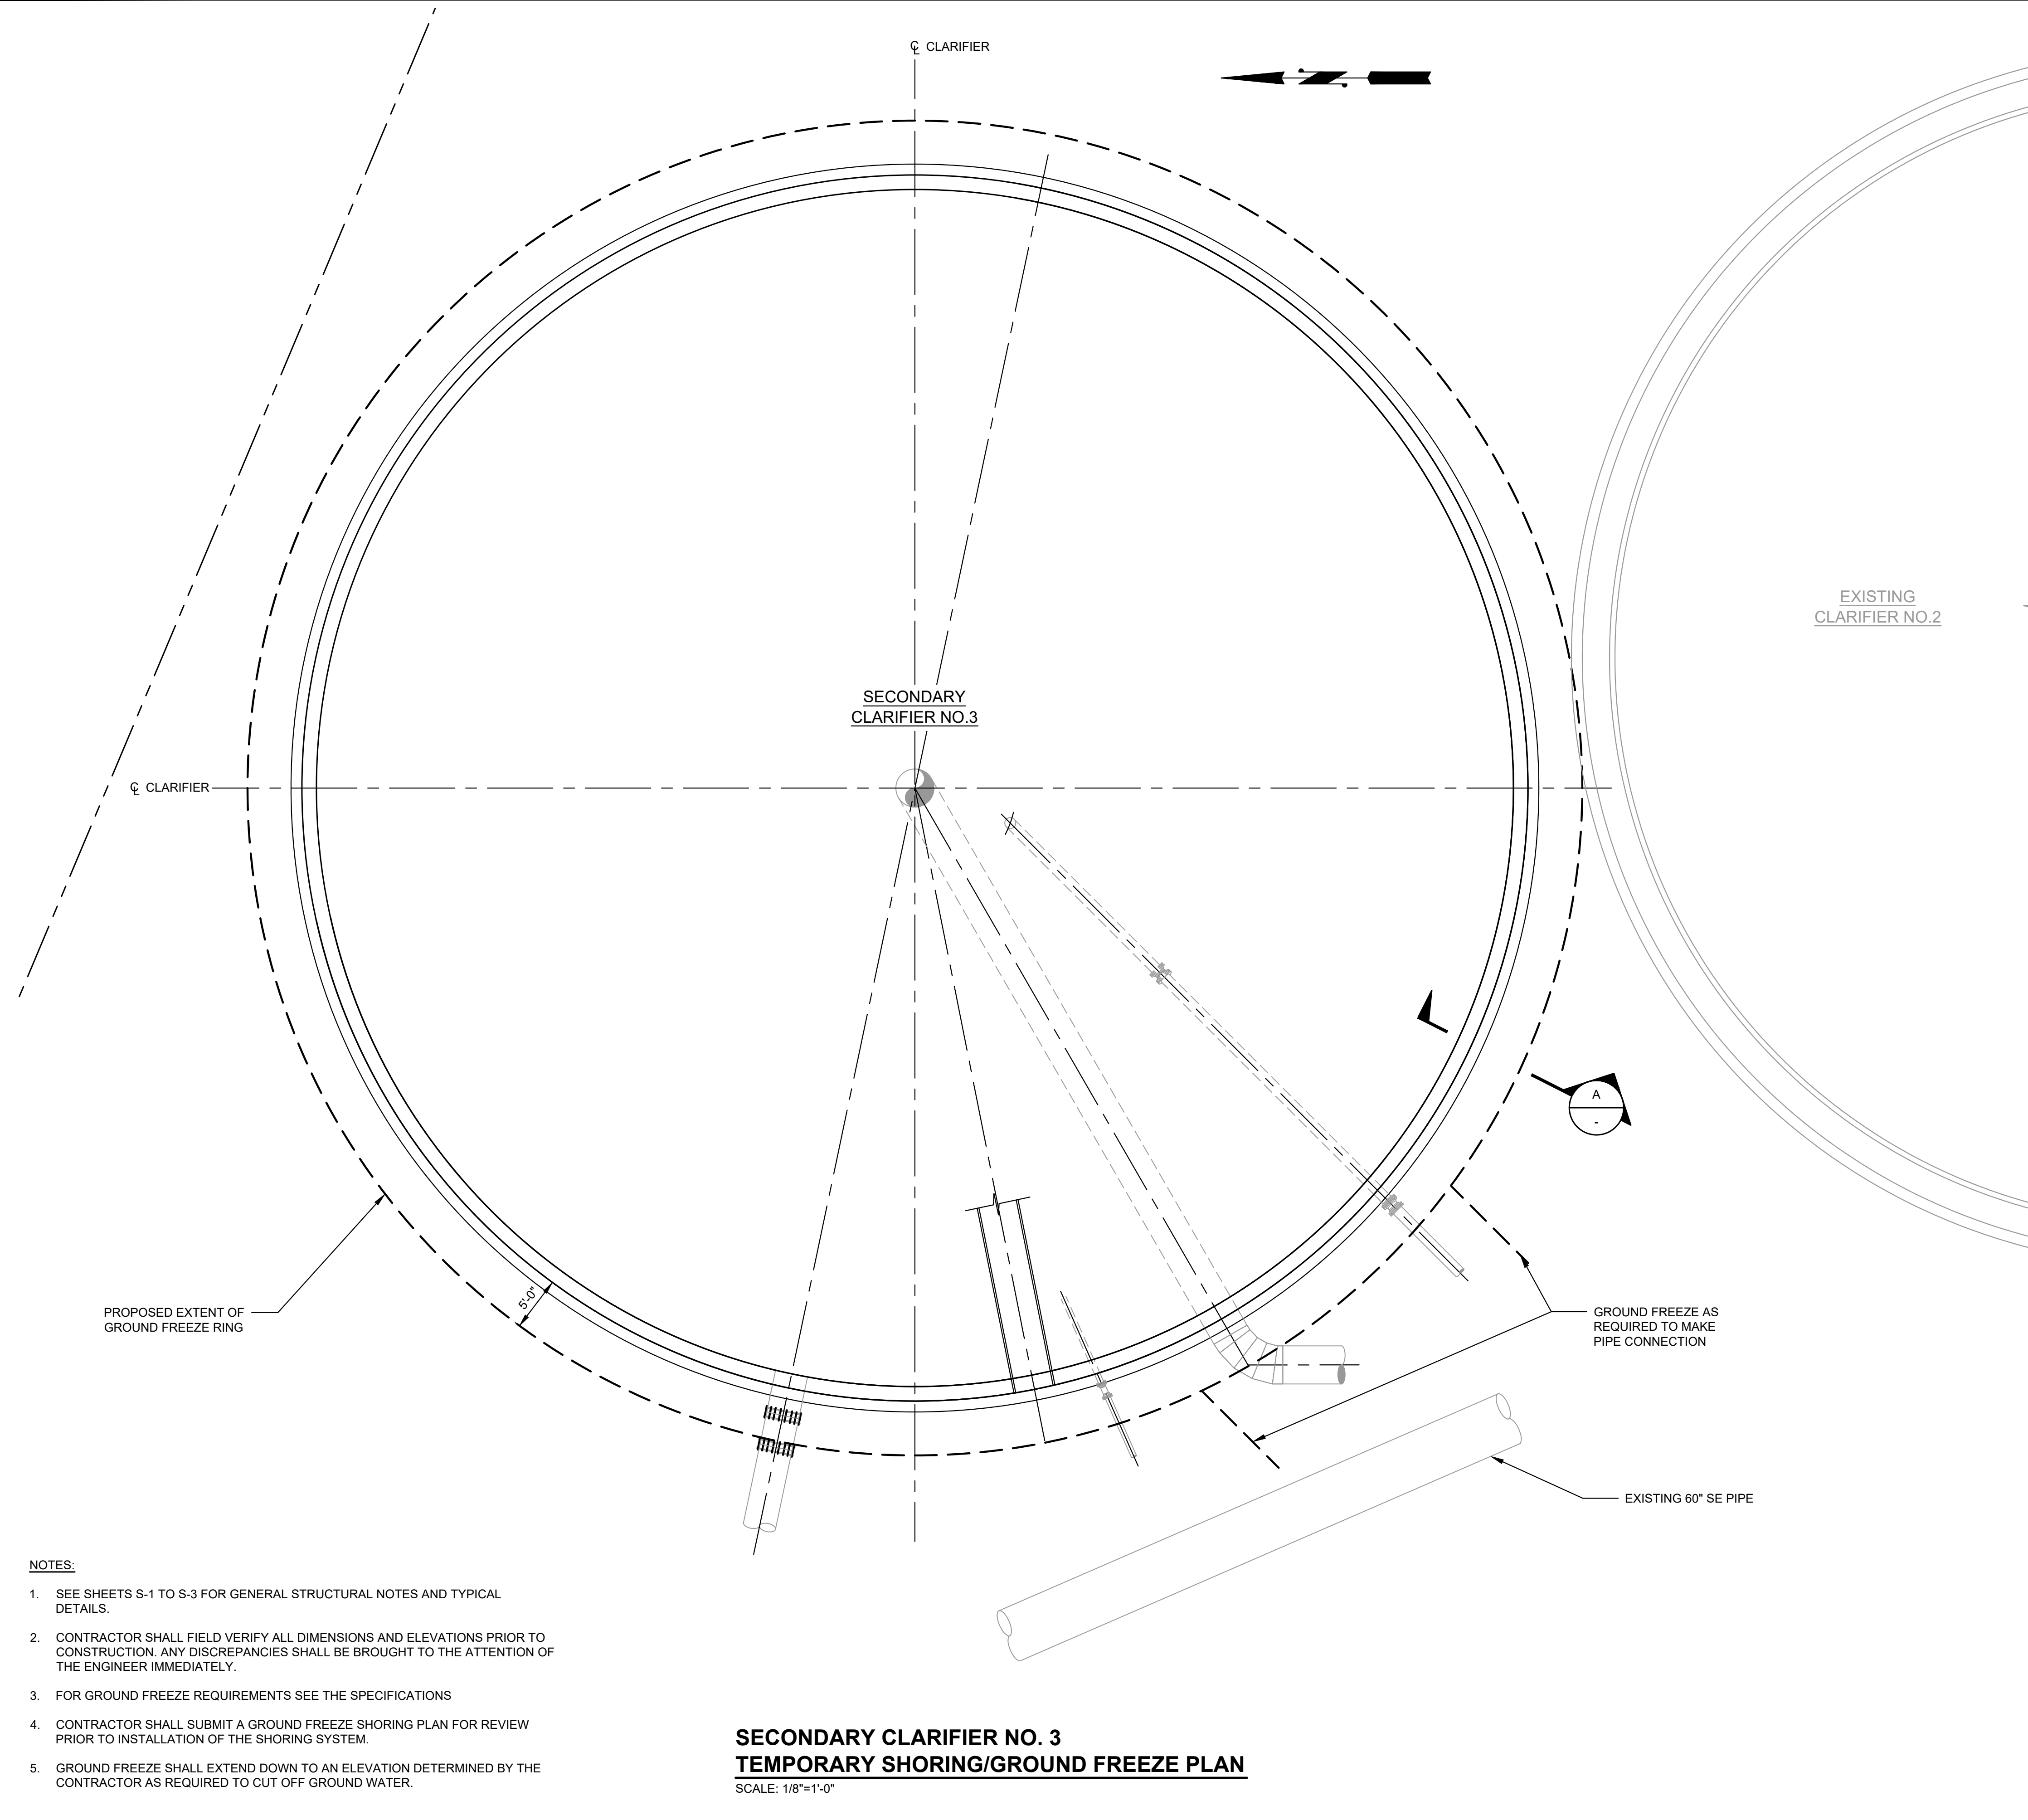

SECTION A
SCALE: 1/2"=1'-0"

- NOTES:**
- SEE SHEETS S-1 TO S-3 FOR GENERAL STRUCTURAL NOTES AND TYPICAL DETAILS.
 - CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS AND ELEVATIONS PRIOR TO CONSTRUCTION. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER IMMEDIATELY.
 - FOR GROUND FREEZE REQUIREMENTS SEE THE SPECIFICATIONS
 - CONTRACTOR SHALL SUBMIT A GROUND FREEZE SHORING PLAN FOR REVIEW PRIOR TO INSTALLATION OF THE SHORING SYSTEM.
 - GROUND FREEZE SHALL EXTEND DOWN TO AN ELEVATION DETERMINED BY THE CONTRACTOR AS REQUIRED TO CUT OFF GROUND WATER.

**SECONDARY CLARIFIER NO. 3
TEMPORARY SHORING/GROUND FREEZE PLAN**
SCALE: 1/8"=1'-0"

APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP

APPROVED
DATE: _____


EXPIRATION
DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans.

Field conditions may dictate changes to these plans as determined by the City Engineer.


Gray & Osborne, Inc.
CONSULTING ENGINEERS
1130 RAINIER AVENUE SOUTH,
SUITE 300
SEATTLE, WASHINGTON 98144
(206) 284-0860

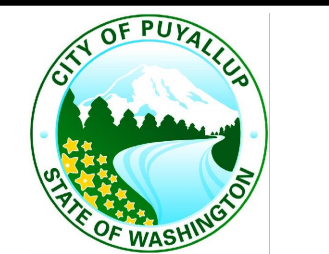

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**


No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY:		MJB
CHECKED BY:		AQ
DRAWN BY:		RAH
DESIGNER:		MJB
G & O JOB NO.:		21462
FILE:		S7_SC3_PLN.DWG



STRUCTURAL


**SECONDARY CLARIFIER NO. 3
TEMPORARY SHORING/GROUND FREEZE PLAN**

DRAWING: **S7-1** OF: **4**

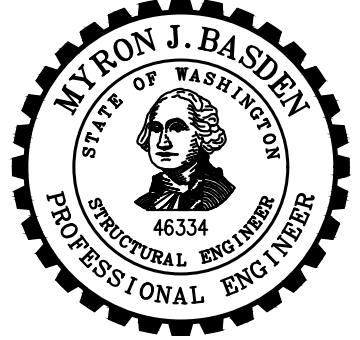



PRELIMINARY
NOT FOR
CONSTRUCTION

No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: MJB		
CHECKED BY: AQ		
DRAWN BY: RAH		
DESIGNER: MJB		
G & O JOB NO.: 21462		
FILE: S7_SC3_PLN.DWG		



STRUCTURAL

SECONDARY CLARIFIER NO. 3 FOUNDATION PLAN AND DETAIL

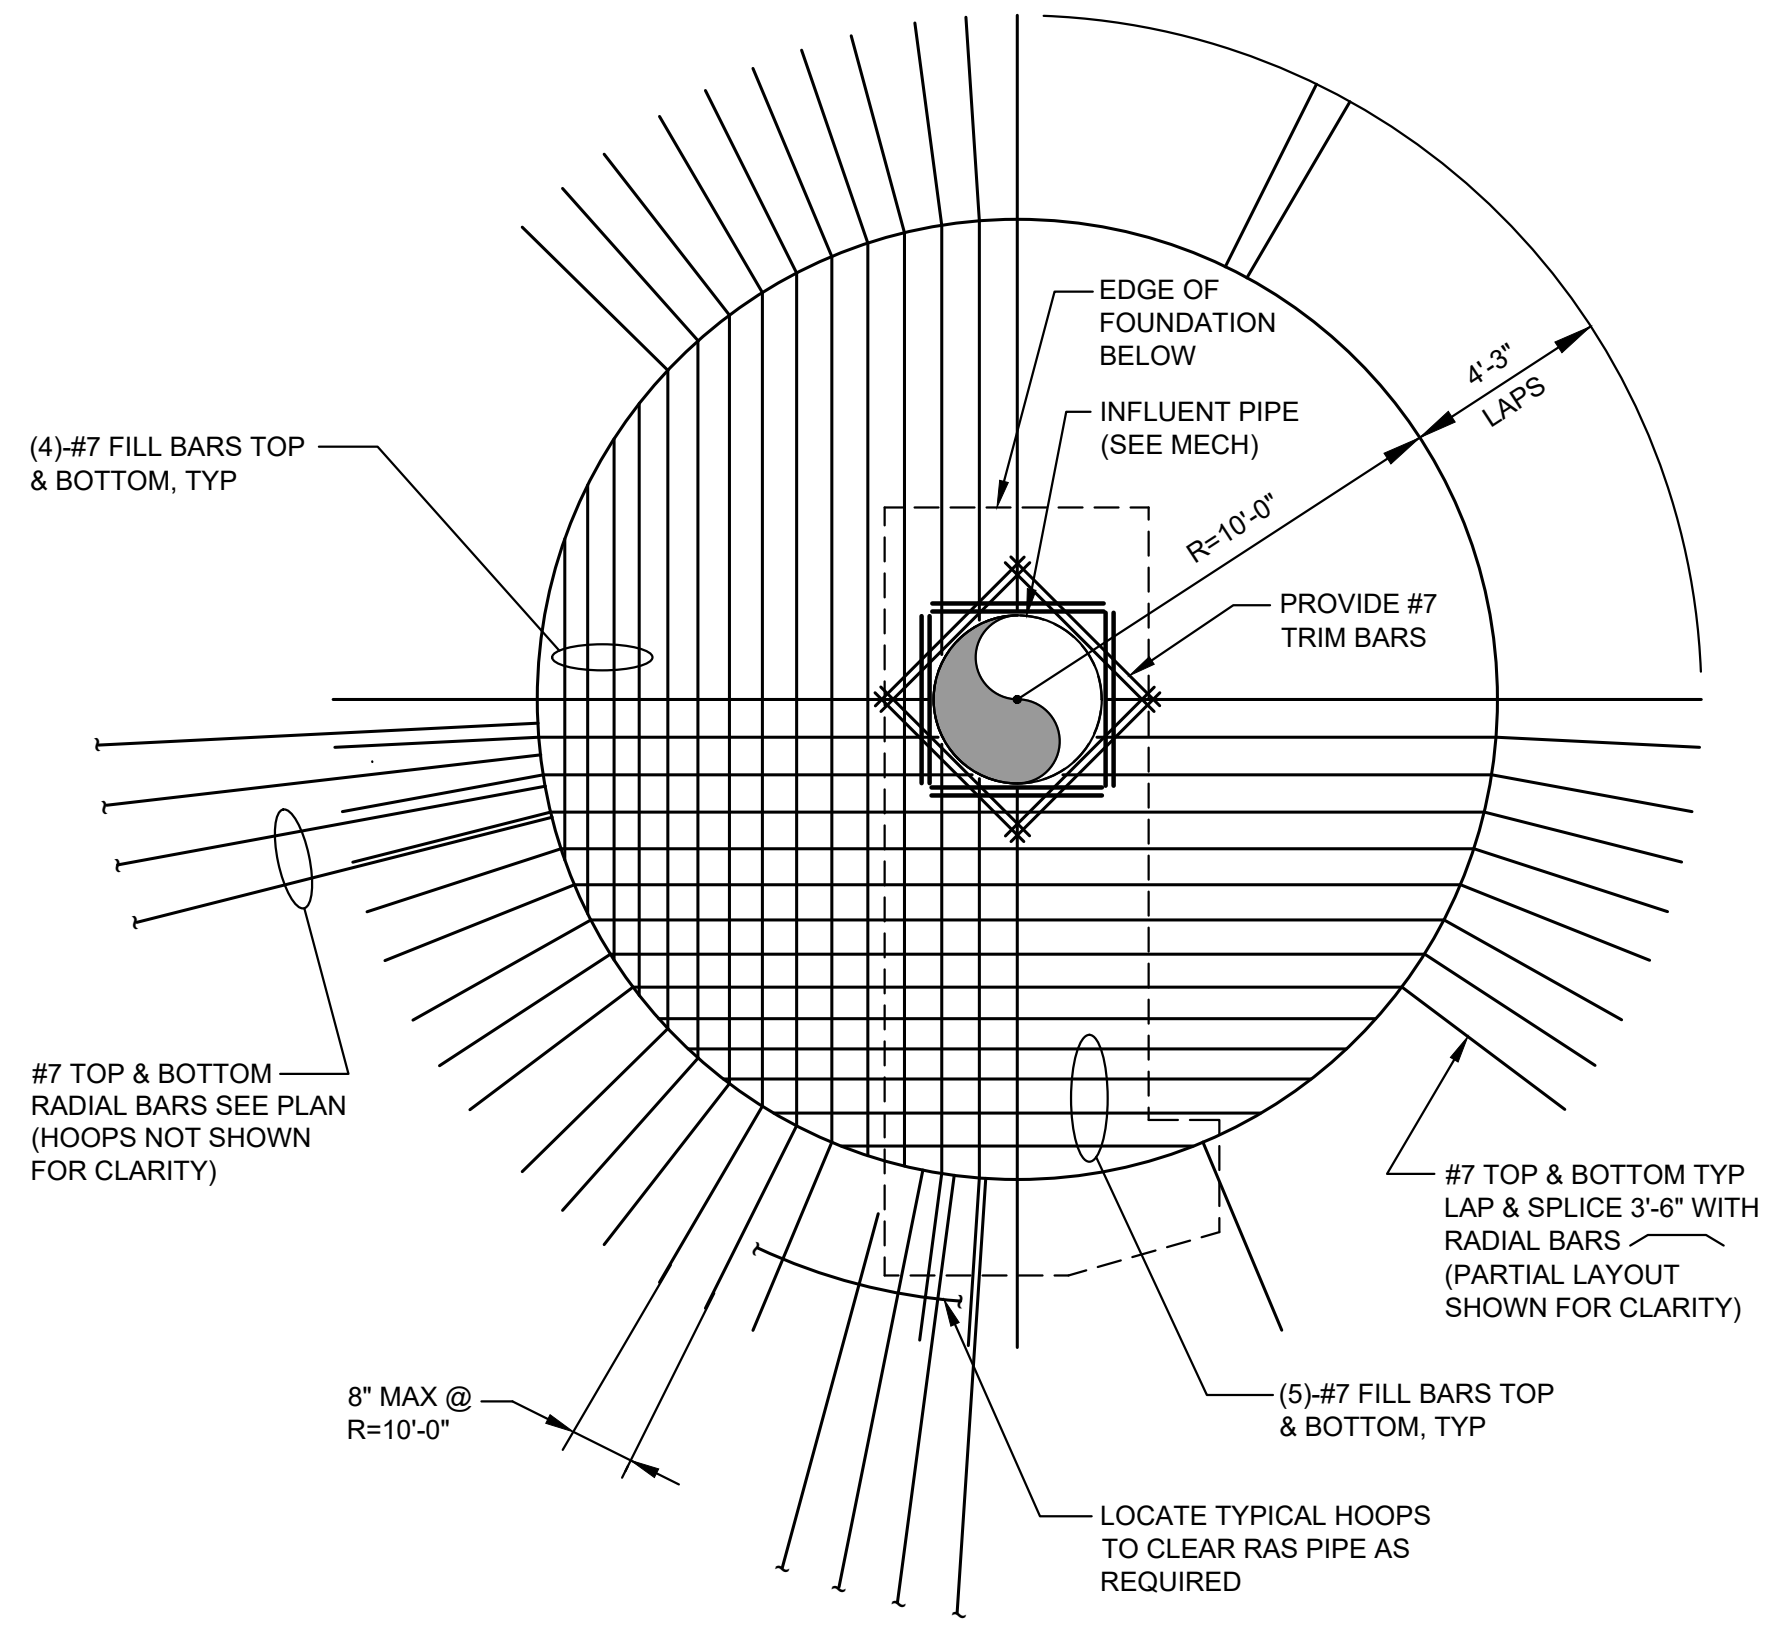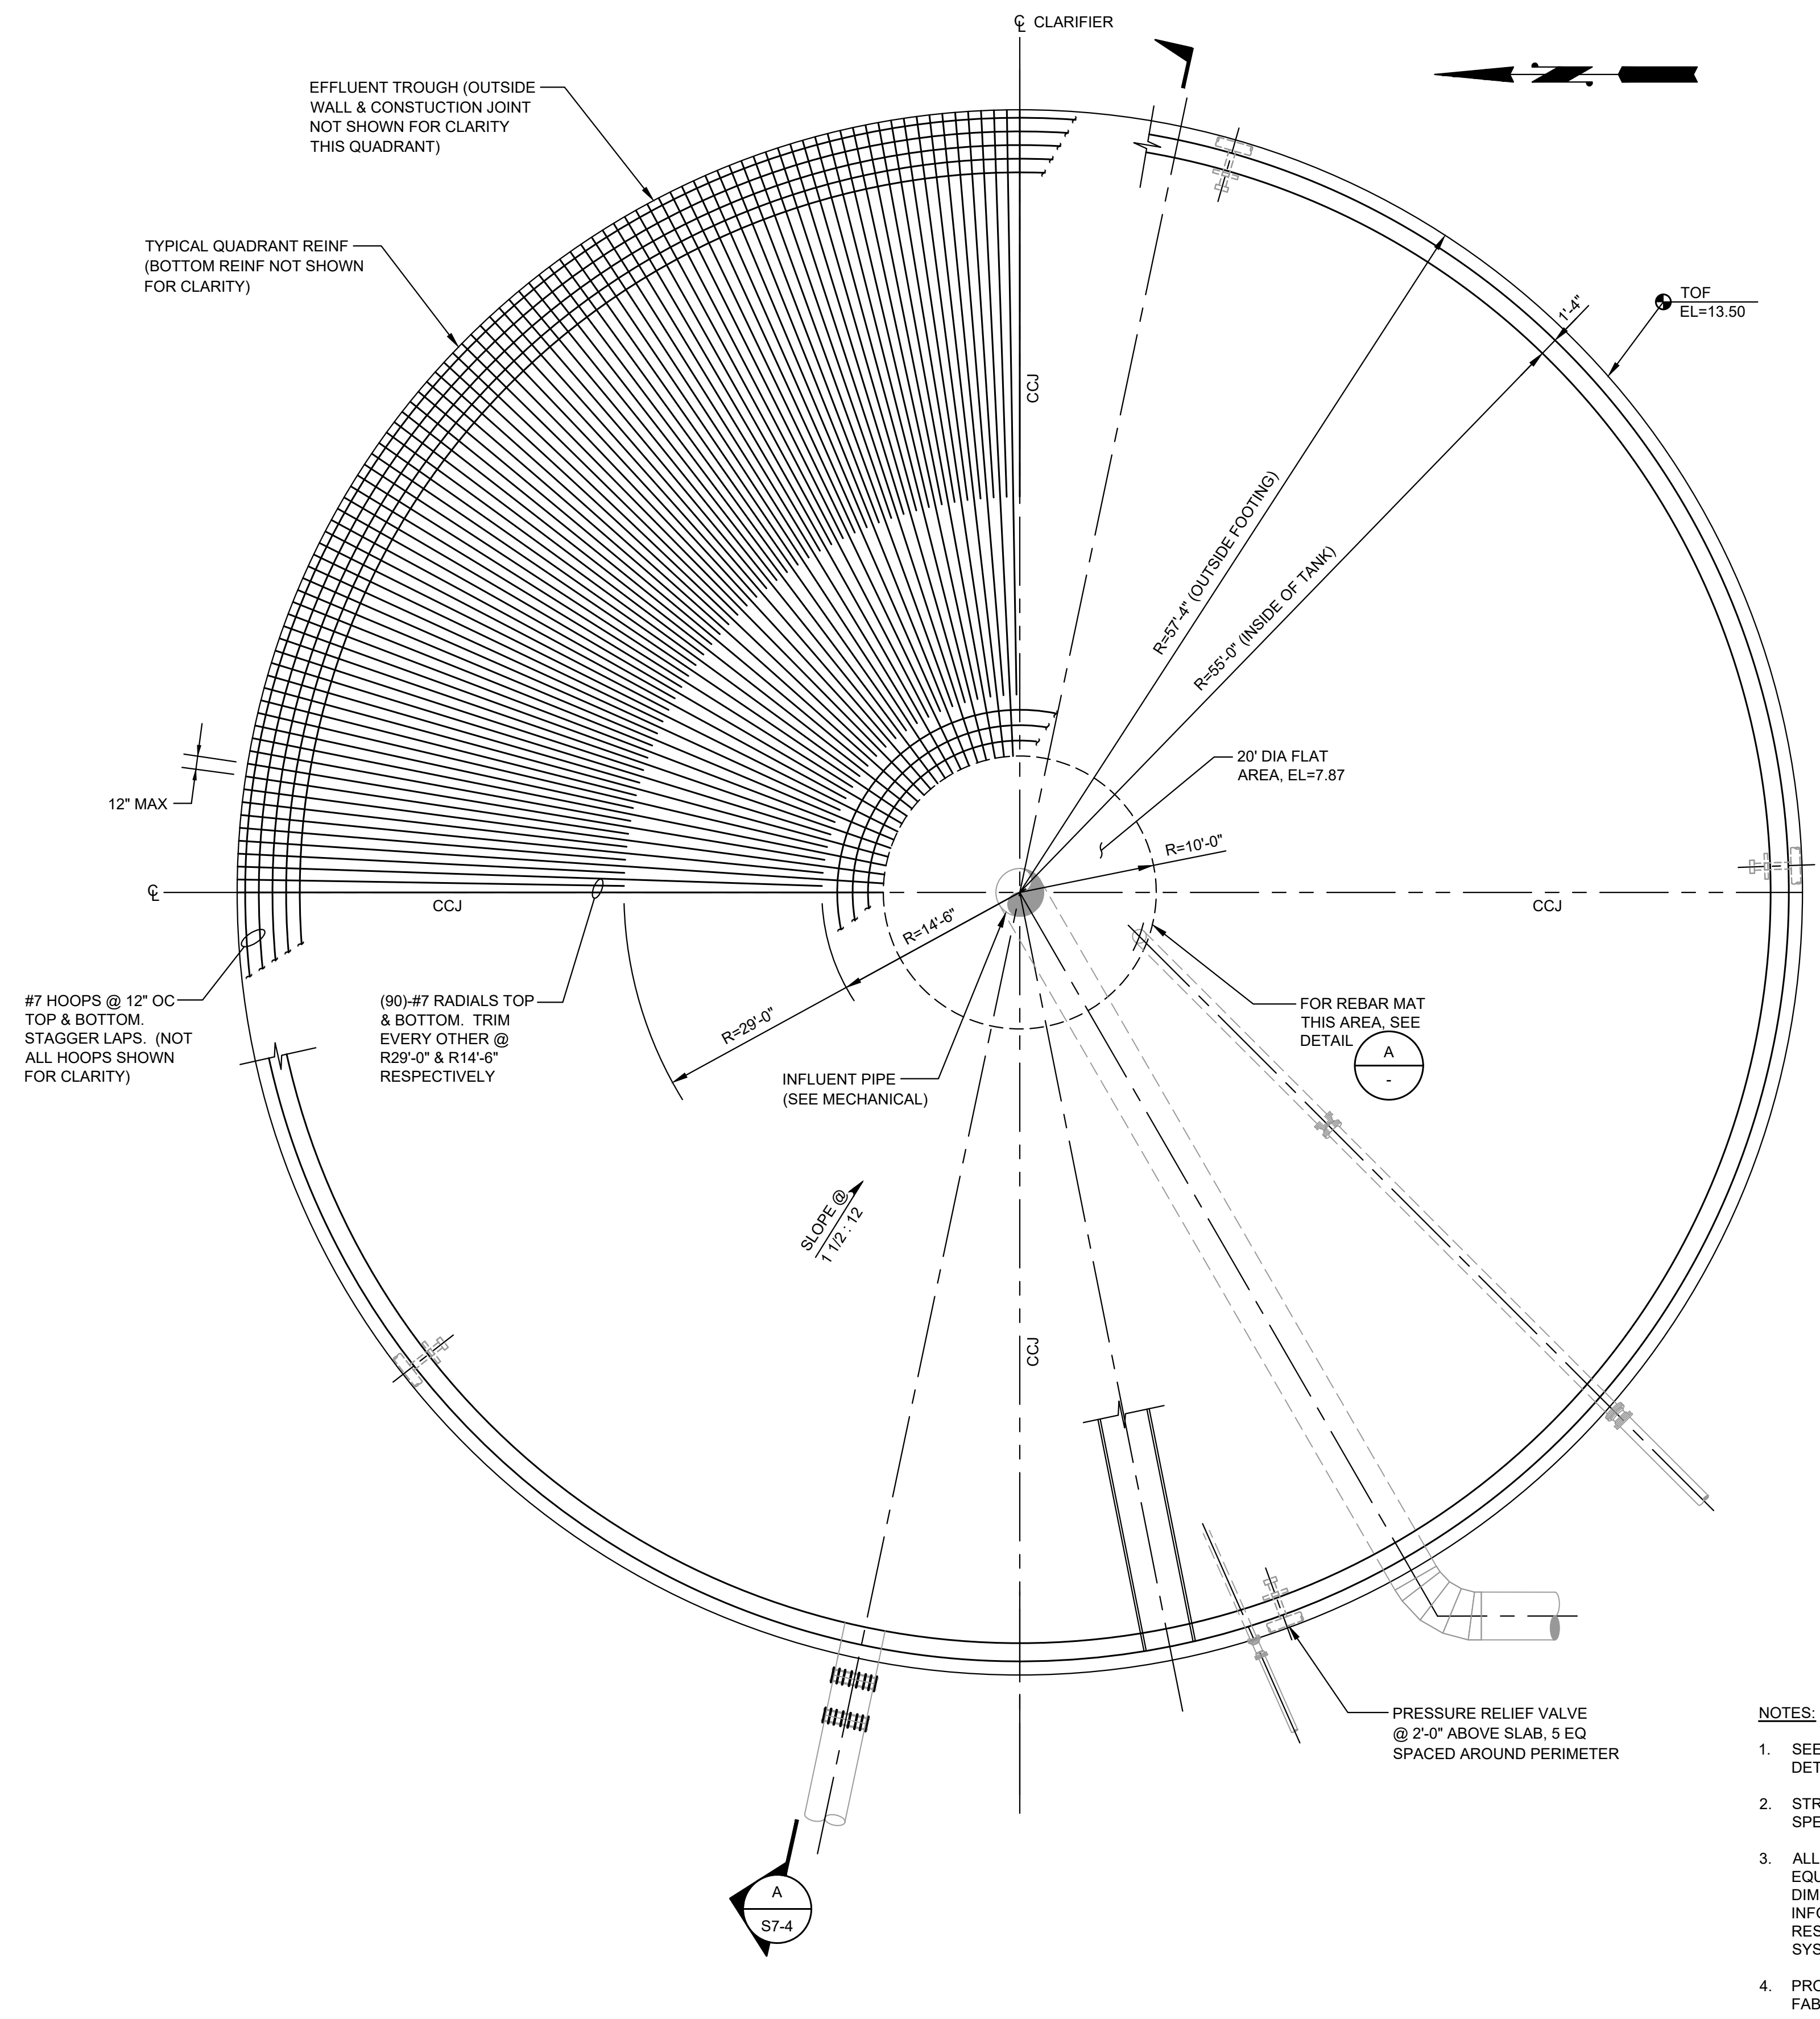

REBAR MAT PLAN DETAIL
 SCALE: 1/4"=1'-0"

NOTES:

- SEE SHEETS S-1 TO S-3 FOR GENERAL STRUCTURAL NOTES AND TYPICAL DETAILS.
- STRUCTURAL STEEL SHALL BE HOT-DIP GALVANIZED IN ACCORDANCE WITH THE SPECIFICATIONS.
- ALL DIMENSIONS SHALL BE DETERMINED, COORDINATED AND VERIFIED BY THE EQUIPMENT MANUFACTURER PRIOR TO ANY CONCRETE CONSTRUCTION. DIMENSIONS AND ELEVATIONS SHOWN ON THE DRAWINGS ARE FOR INFORMATION PURPOSES ONLY. IT SHALL BE THE CONTRACTOR'S SOLE RESPONSIBILITY TO COORDINATE ALL DIMENSIONS WITH THE EQUIPMENT SYSTEMS MANUFACTURER.
- PROVIDE 4" MIN PVC WATERSTOPS AT ALL CONSTRUCTION JOINTS. TYPICAL UNO. FABRICATE REINFORCEMENT TO CLEAR WATERSTOPS BY 1" MINIMUM, TYPICAL.

SECONDARY CLARIFIER NO. 3
FOUNDATION PLAN
 SCALE: 1/8"=1'-0"

APPROVED

BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP

APPROVED
 DATE: _____
 EXPIRATION
 DATE: _____


NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans.


Field conditions may dictate changes to these plans as determined by the City Engineer.

m:\PUYALLUP\21462\wpcp\3rd\secondary clarifier\01 design\PlanSet\Structural\S7_SC3_PLN.dwg, 1/3/2022 2:39 PM, CHARLEY REID

m:\PUYALLUP\21462\wpcp\3rd\secondary clarifier01\design\PlanSet\Structural\S7_SC3_PLN.dwg, 1/3/2022 2:39 PM, CHARLEY REID

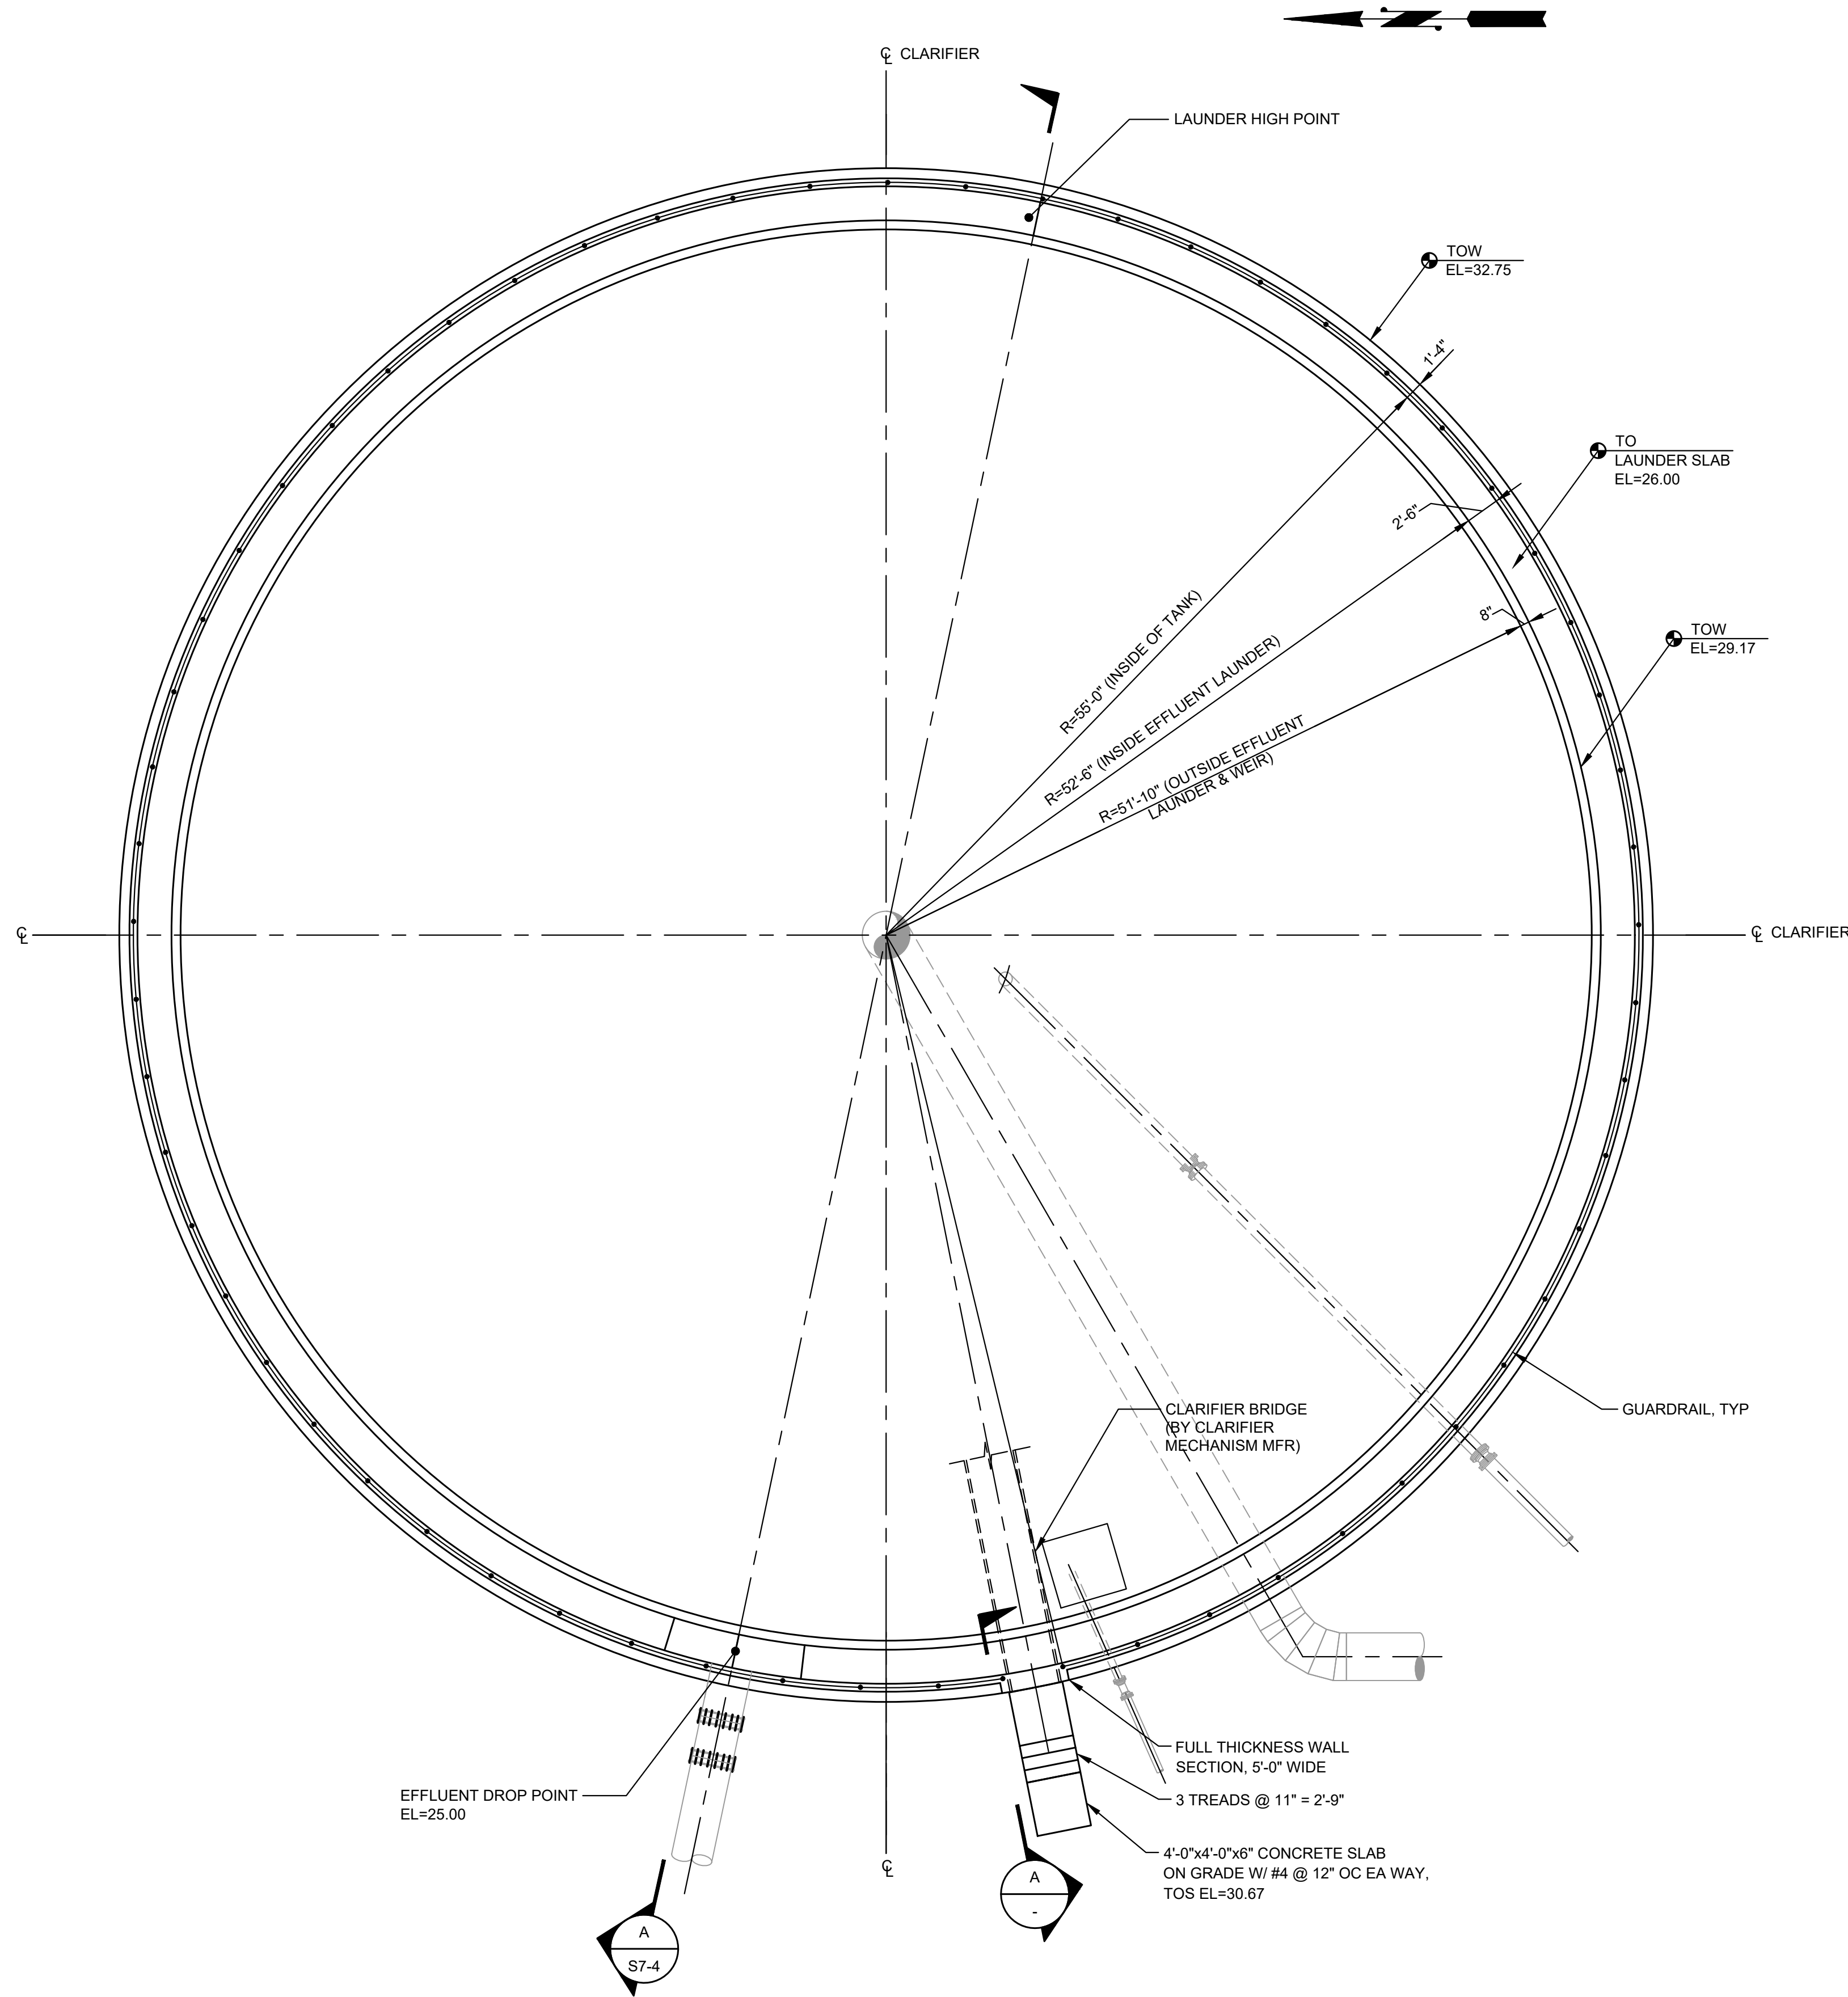

**SECONDARY CLARIFIER NO. 3
UPPER PLAN**
SCALE: 1/8"=1'-0"

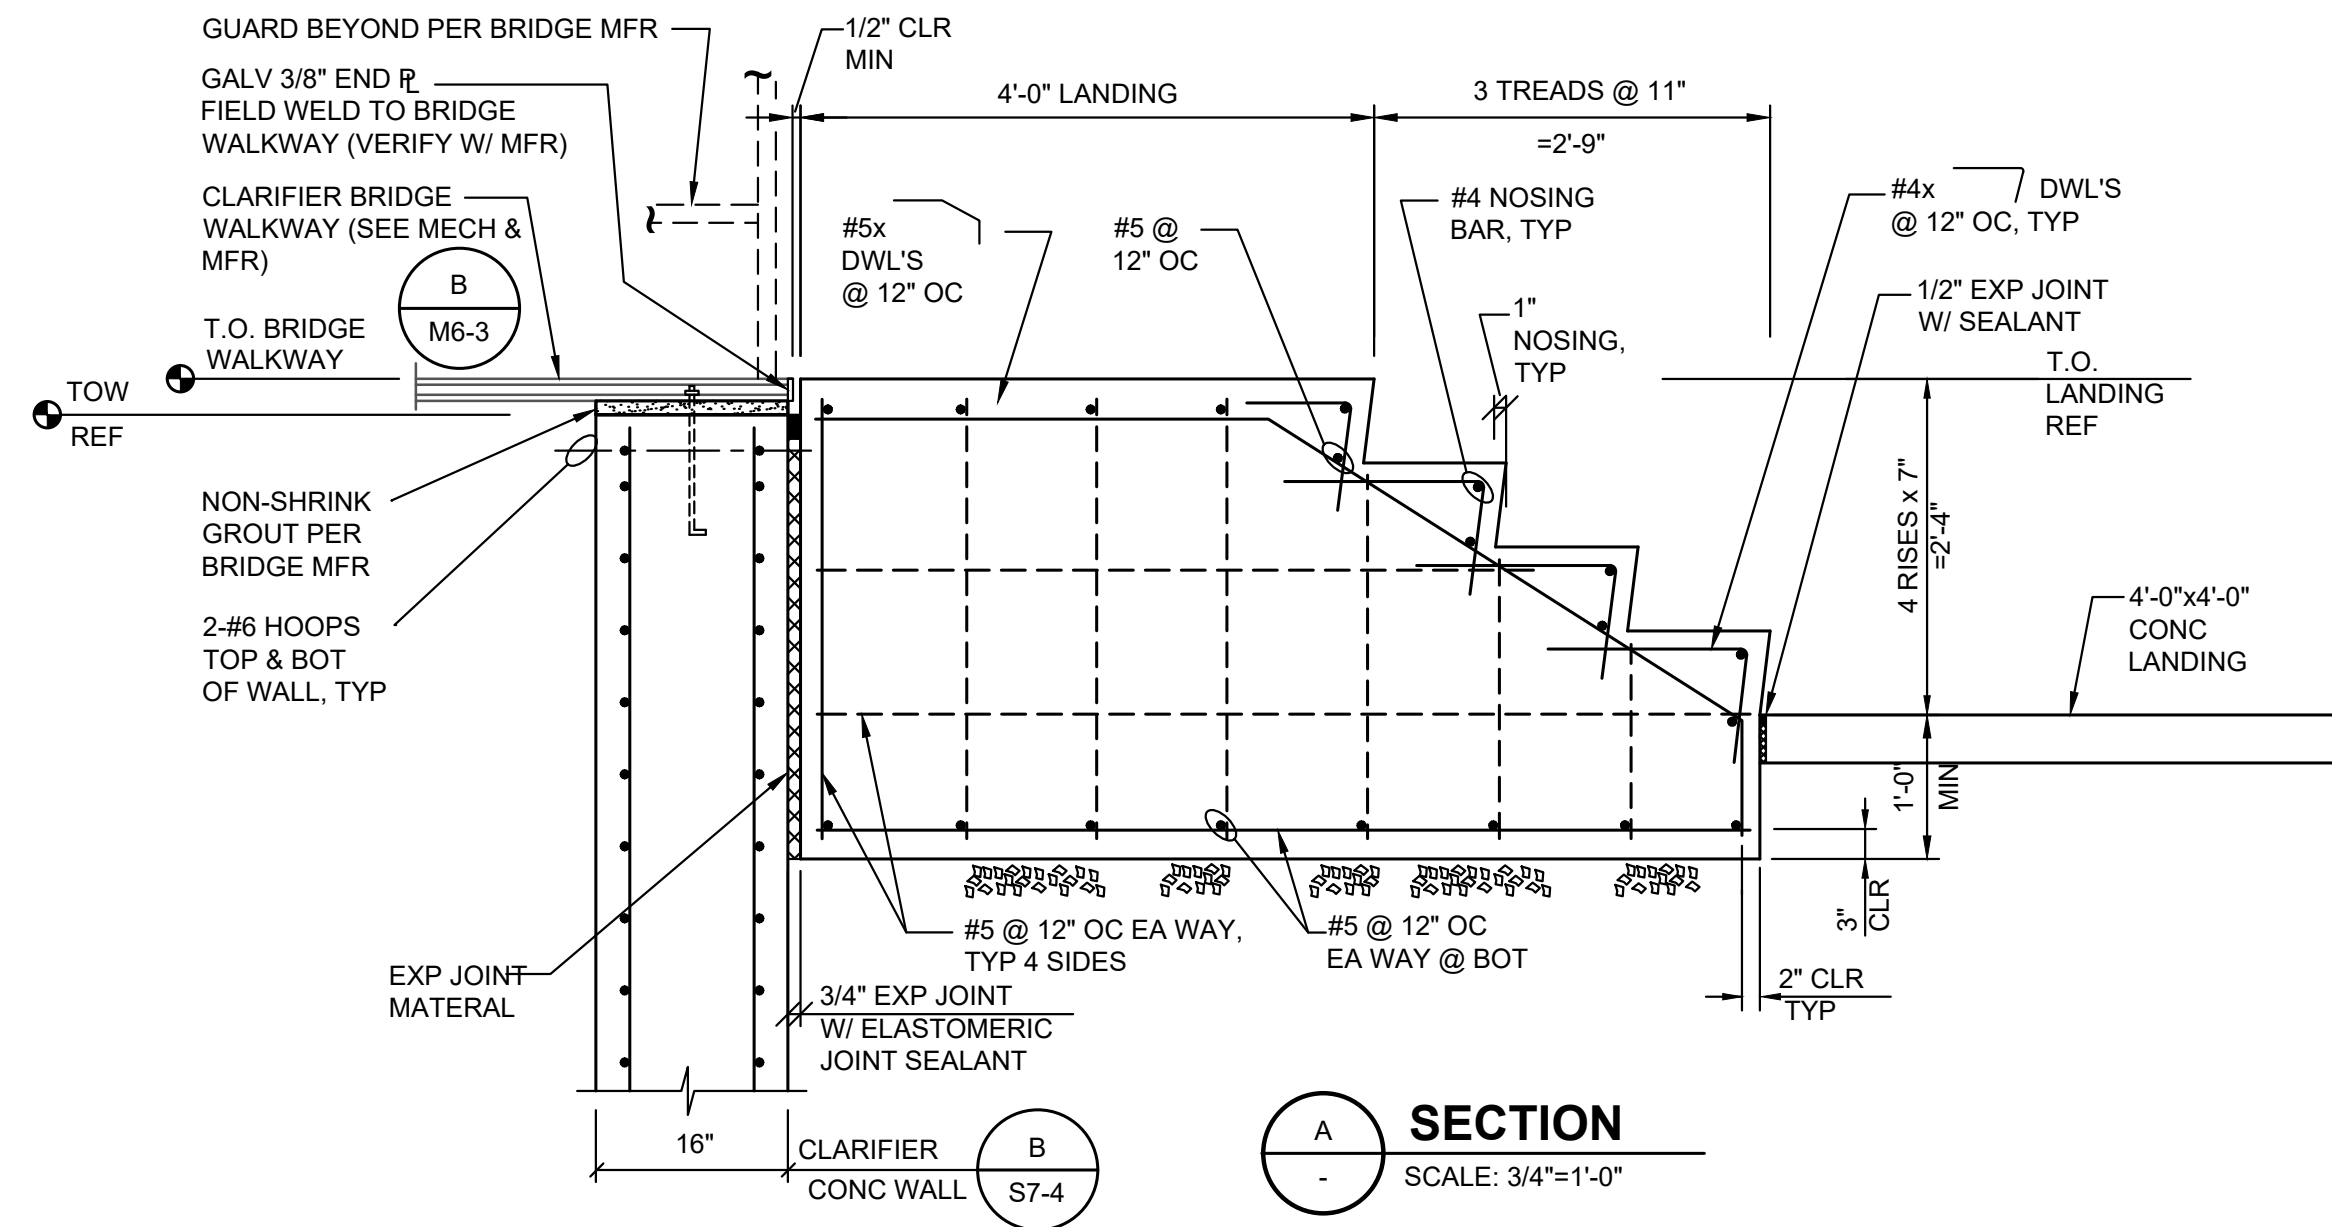

SECTION A-A
SCALE: 3/4"=1'-0"


NOTES:

- SEE SHEETS S-1 TO S-3 FOR GENERAL STRUCTURAL NOTES AND TYPICAL DETAILS.
- STRUCTURAL STEEL SHALL BE HOT-DIP GALVANIZED IN ACCORDANCE WITH THE SPECIFICATIONS.
- ALL DIMENSIONS SHALL BE DETERMINED, COORDINATED AND VERIFIED BY THE EQUIPMENT MANUFACTURER PRIOR TO ANY CONCRETE CONSTRUCTION. DIMENSIONS AND ELEVATIONS SHOWN ON THE DRAWINGS ARE FOR INFORMATION PURPOSES ONLY. IT SHALL BE THE CONTRACTOR'S SOLE RESPONSIBILITY TO COORDINATE ALL DIMENSIONS WITH THE EQUIPMENT SYSTEMS MANUFACTURER.



**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: MJB		
CHECKED BY: AQ		
DRAWN BY: RAH		
DESIGNER: MJB		
G & O JOB NO.: 21462		
FILE: S7_SC3_PLN.DWG		

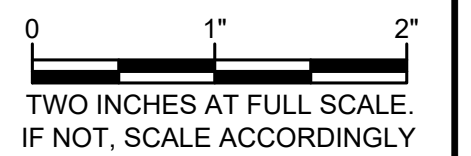

STRUCTURAL

APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.


**SECONDARY
CLARIFIER NO. 3
UPPER PLAN**

DRAWING: **S7-3** OF: **4**



**PRELIMINARY
NOT FOR
CONSTRUCTION**


No.	DATE	REVISION
ISSUED FOR:		
90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: MJB		
CHECKED BY: AQ		
DRAWN BY: RAH		
DESIGNER: MJB		
G & O JOB NO.: 21462		
FILE: S7_SC3_PLN.DWG		




STRUCTURAL

**SECONDARY
CLARIFIER NO. 3
SECTION AND DETAILS**


DRAWING: **S7-4** OF: **4**

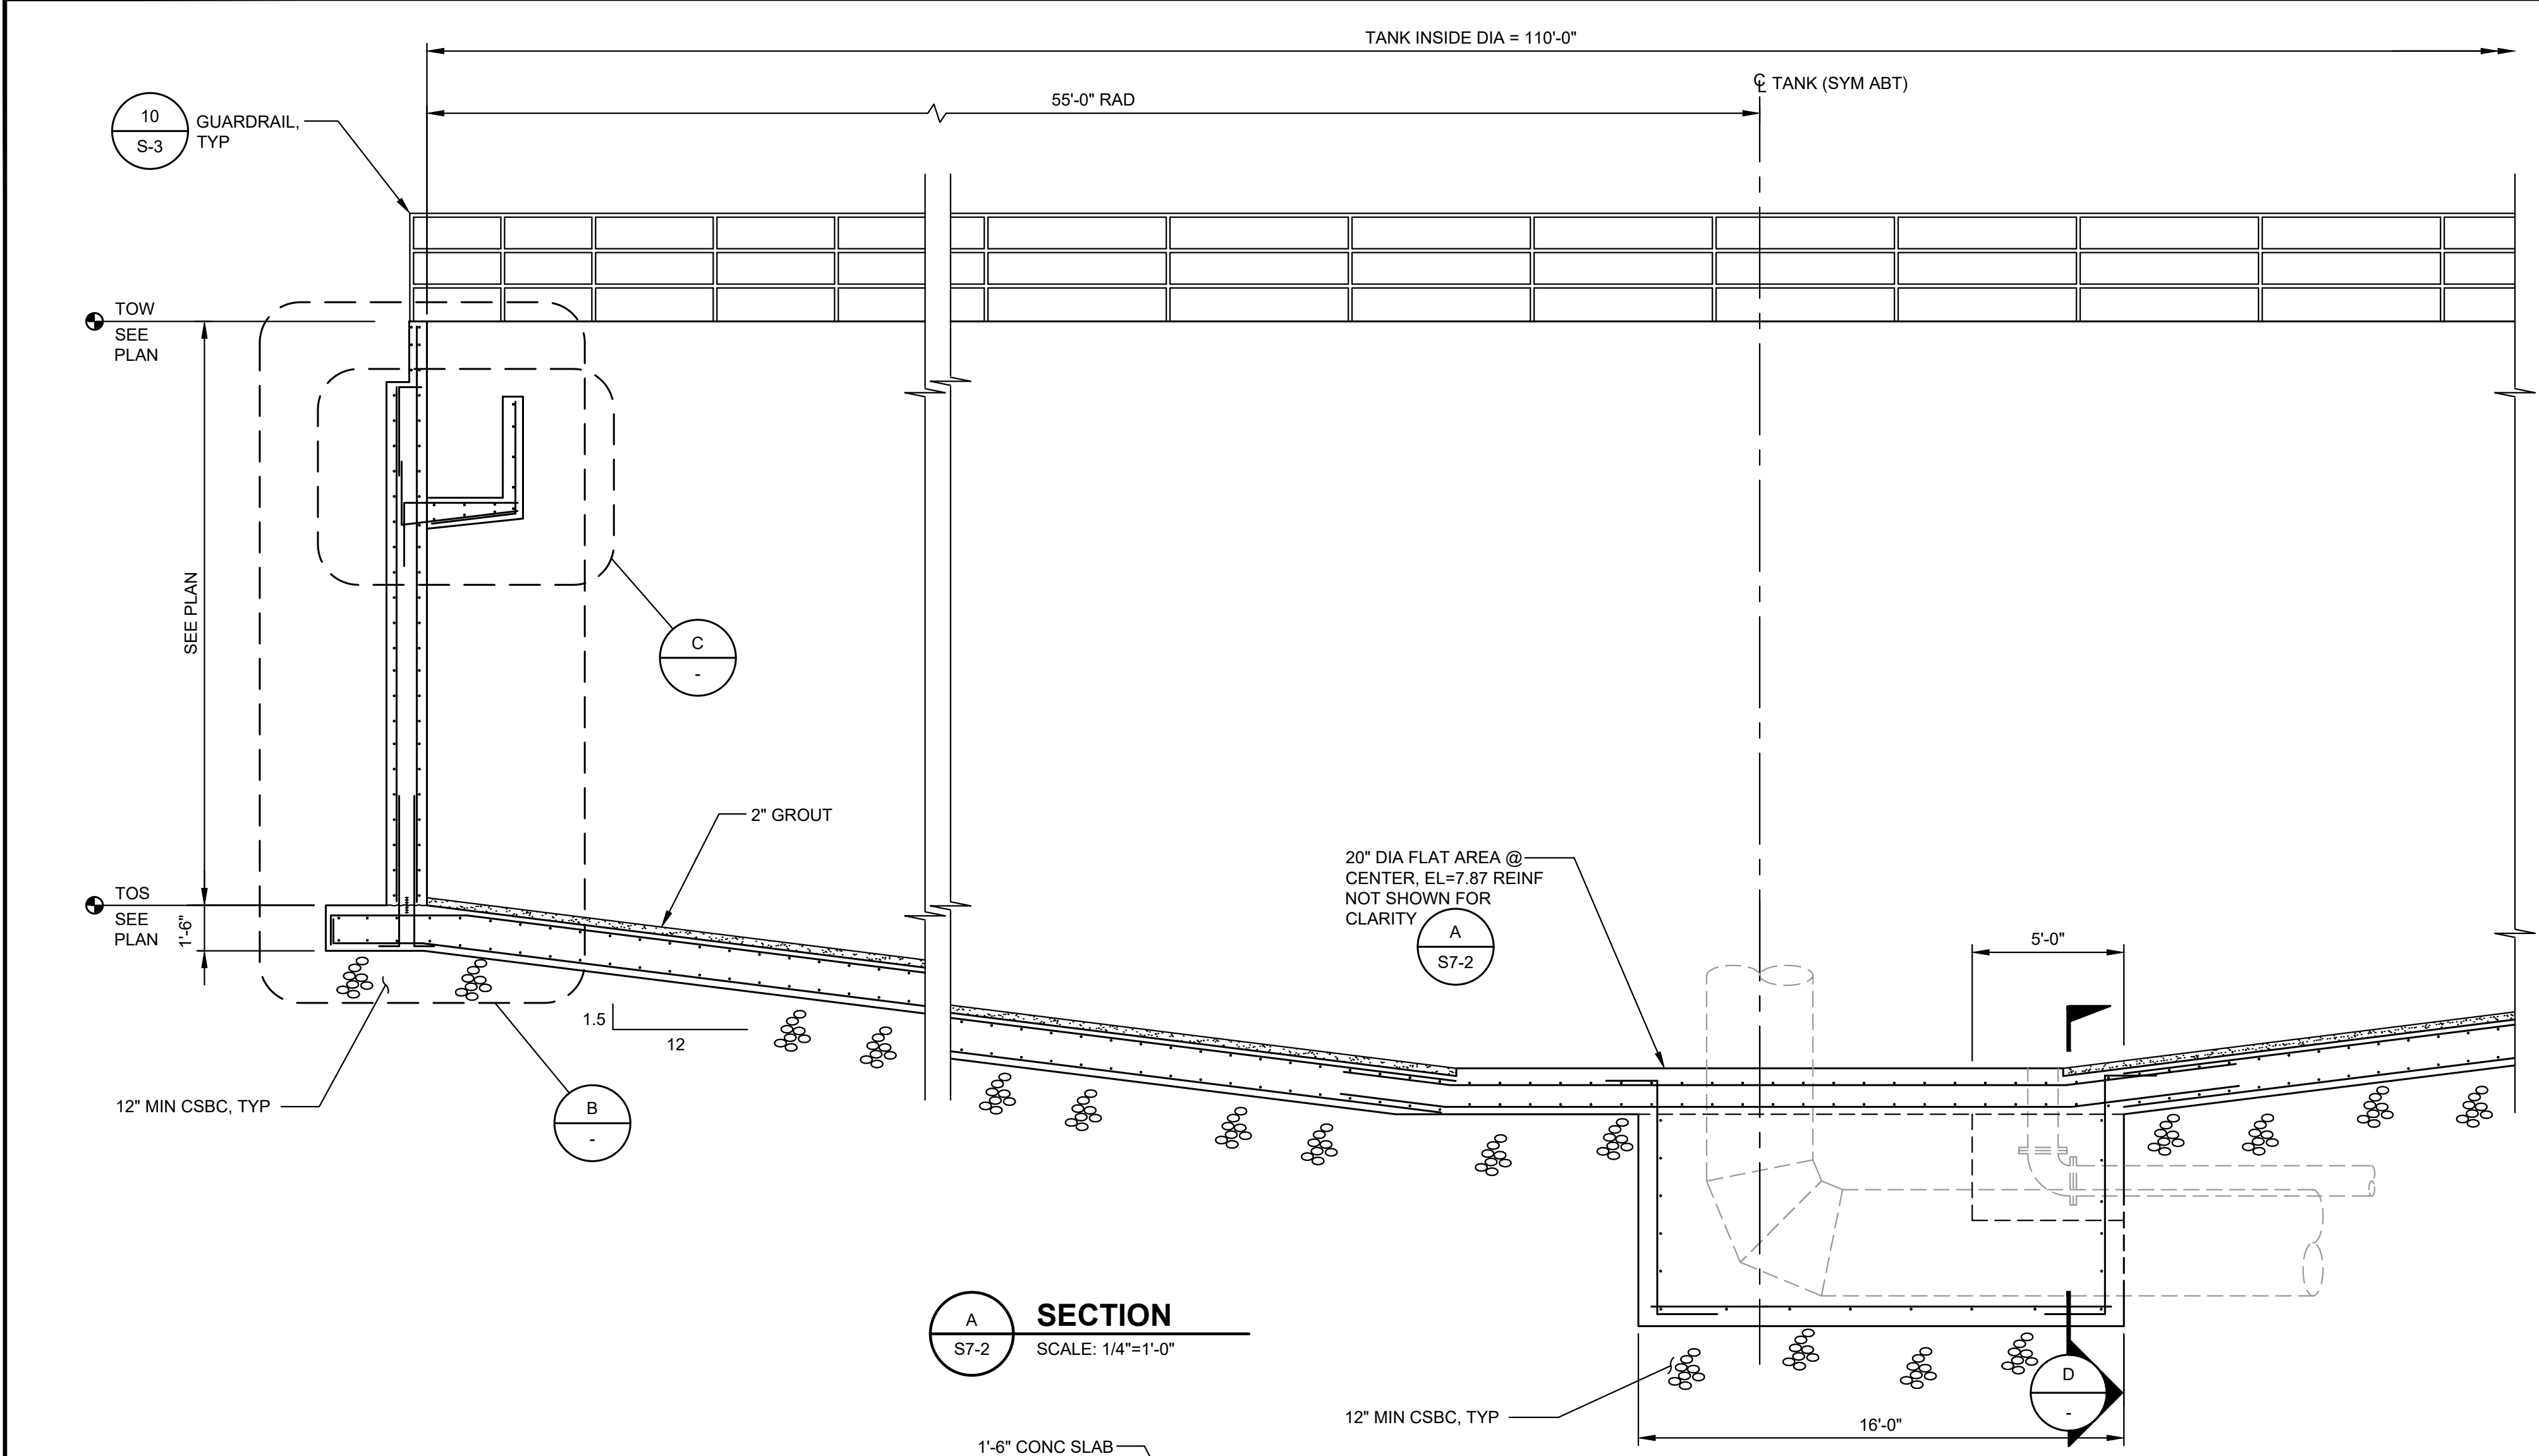


SECTION A
SCALE: 1/4"=1'-0"

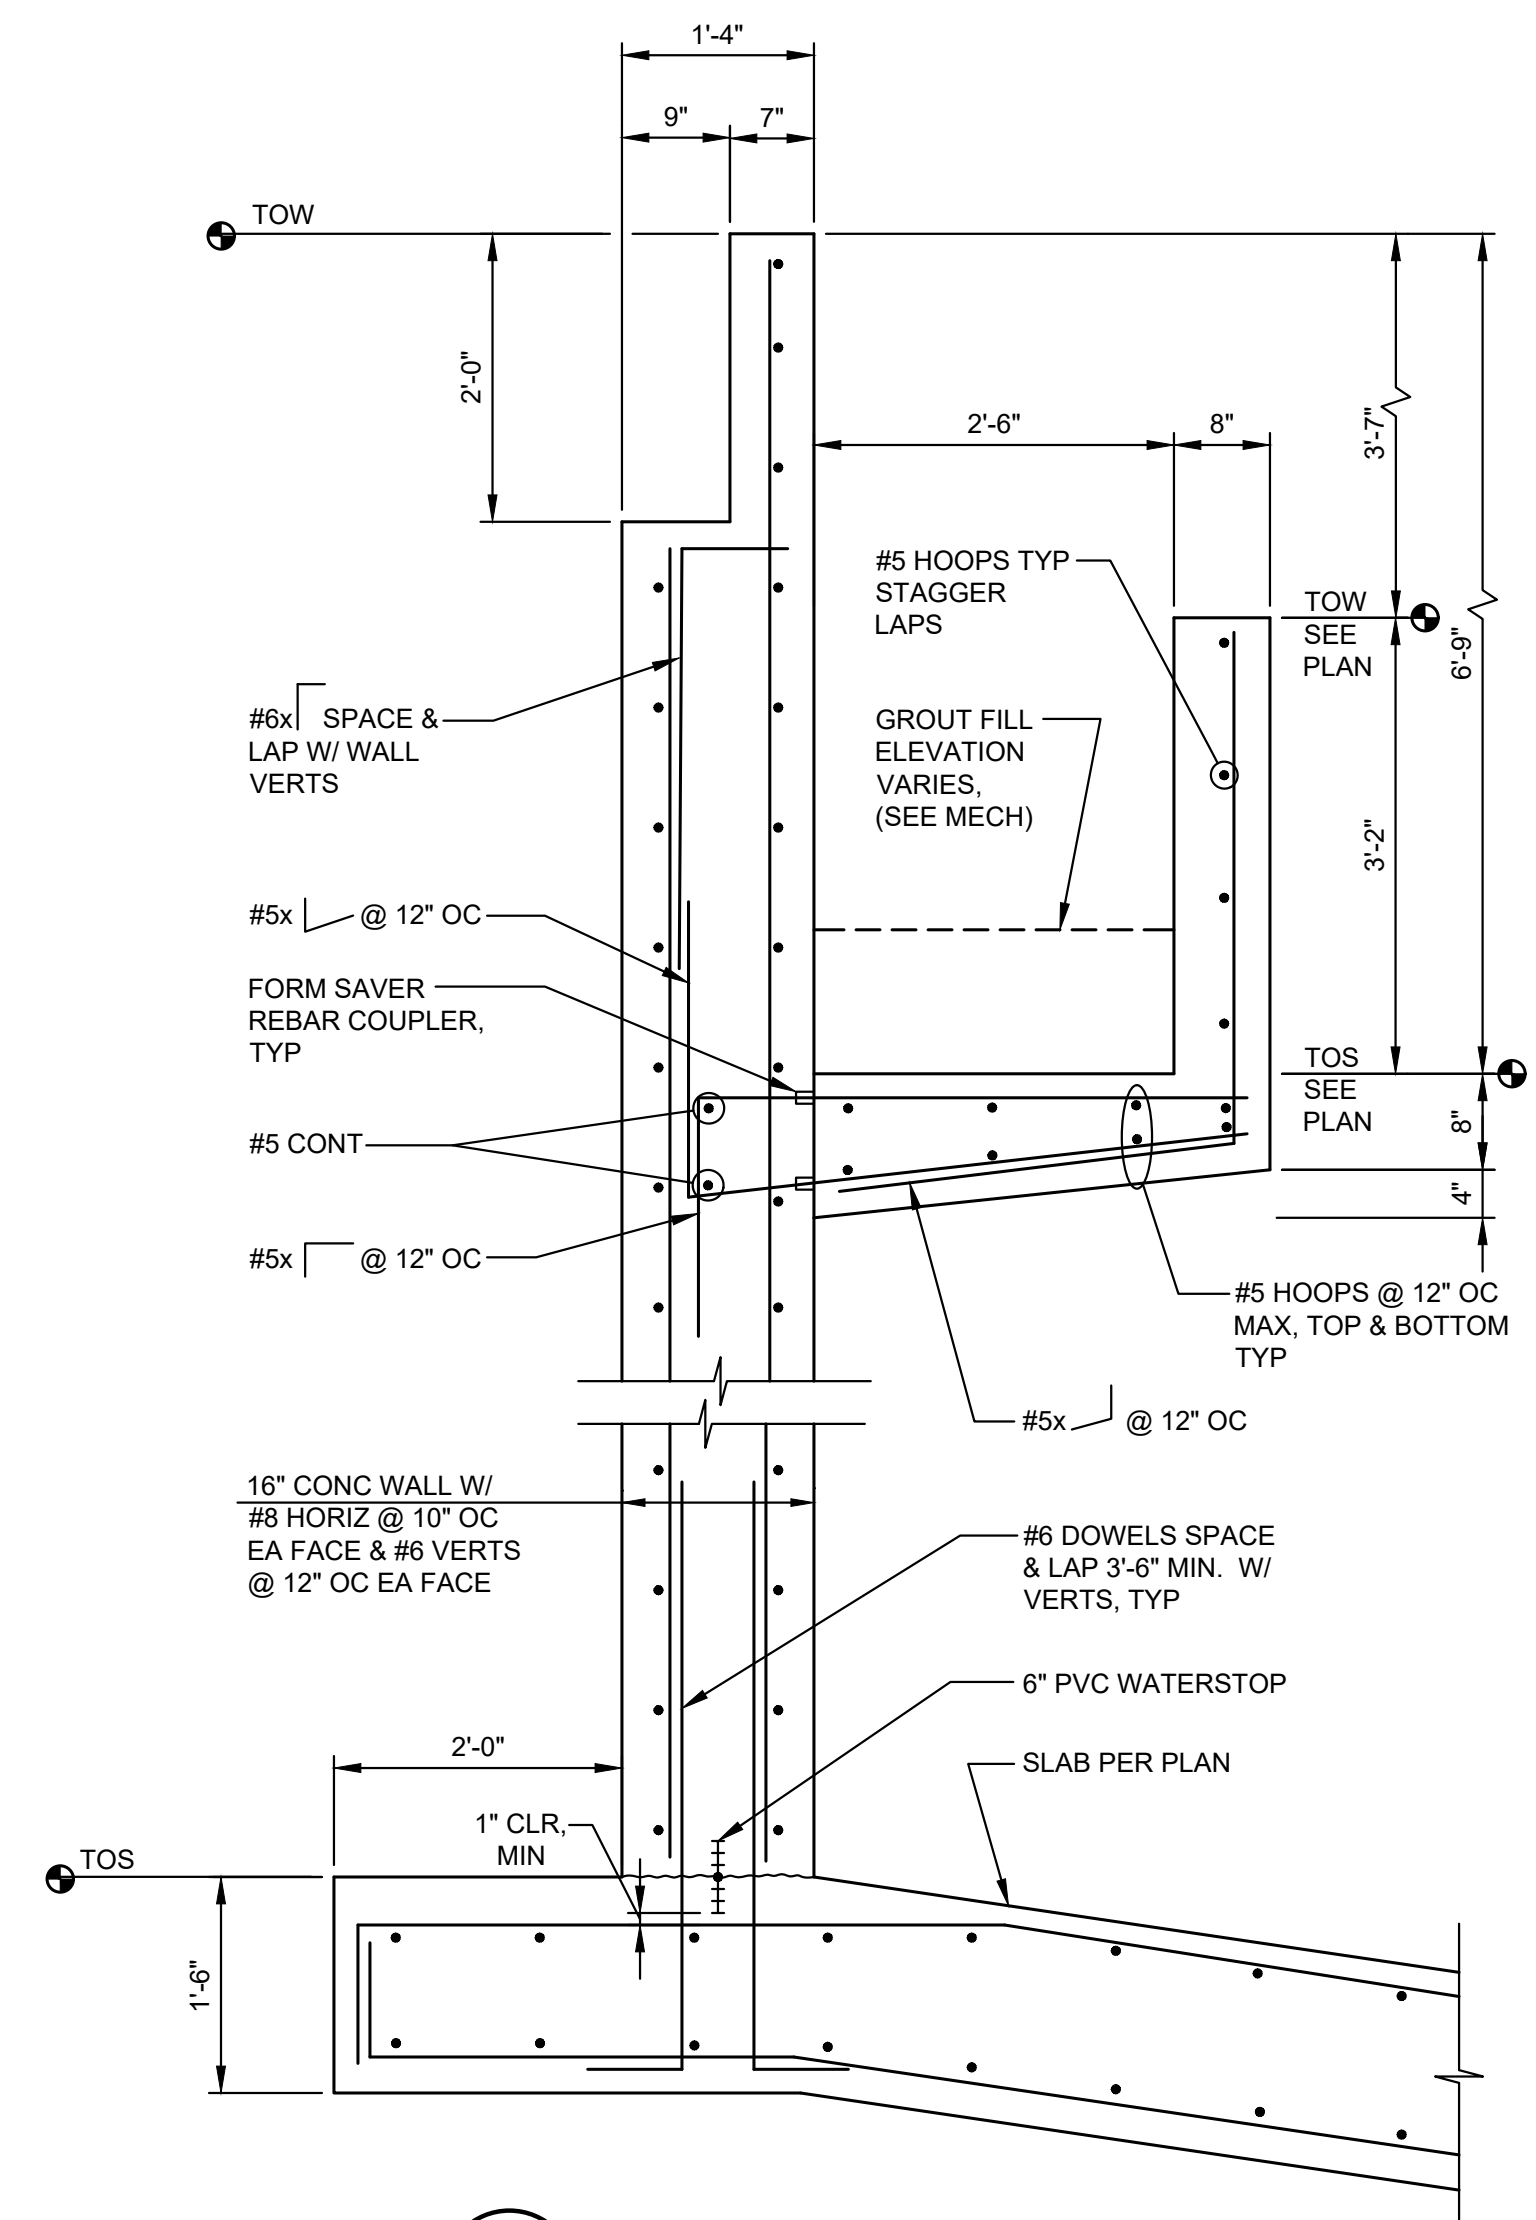


SECTION B
SCALE: 3/4"=1'-0"

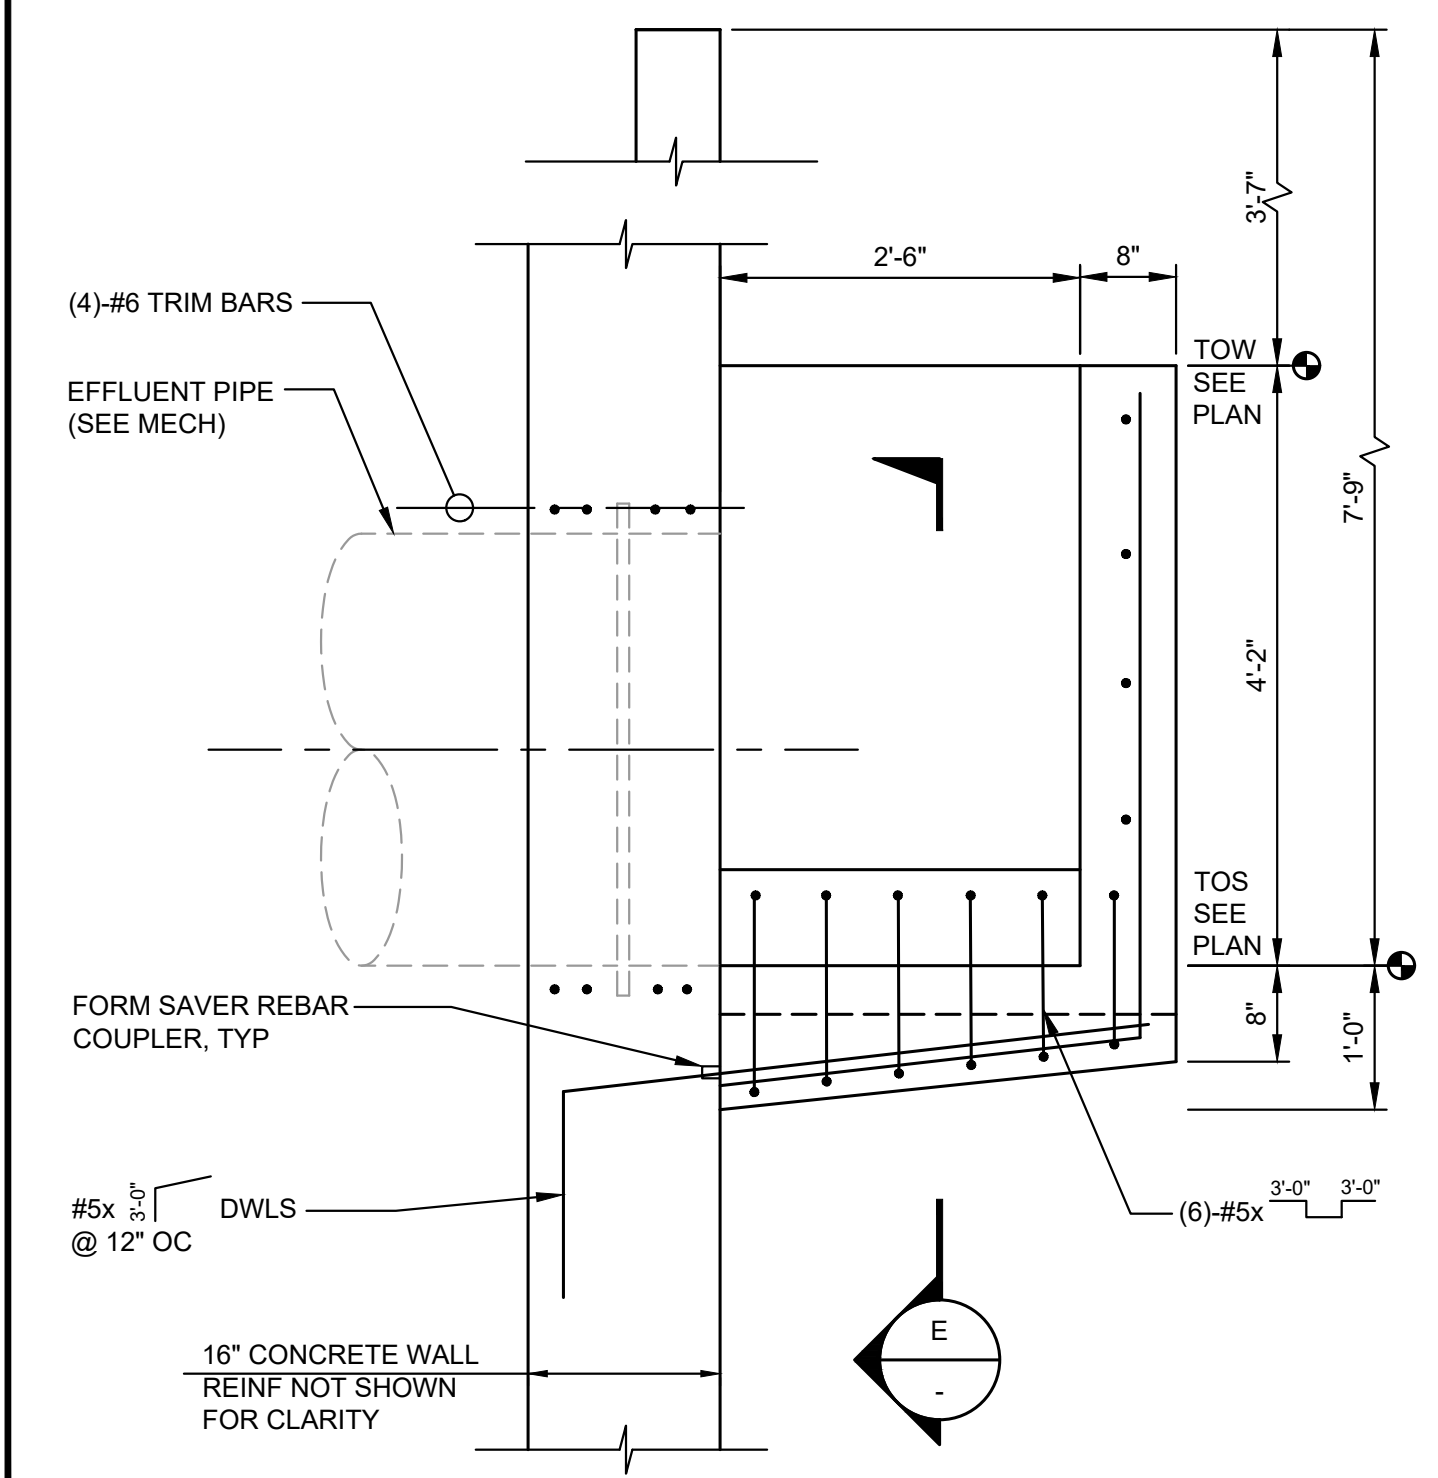

SECTION C
SCALE: 3/4"=1'-0"

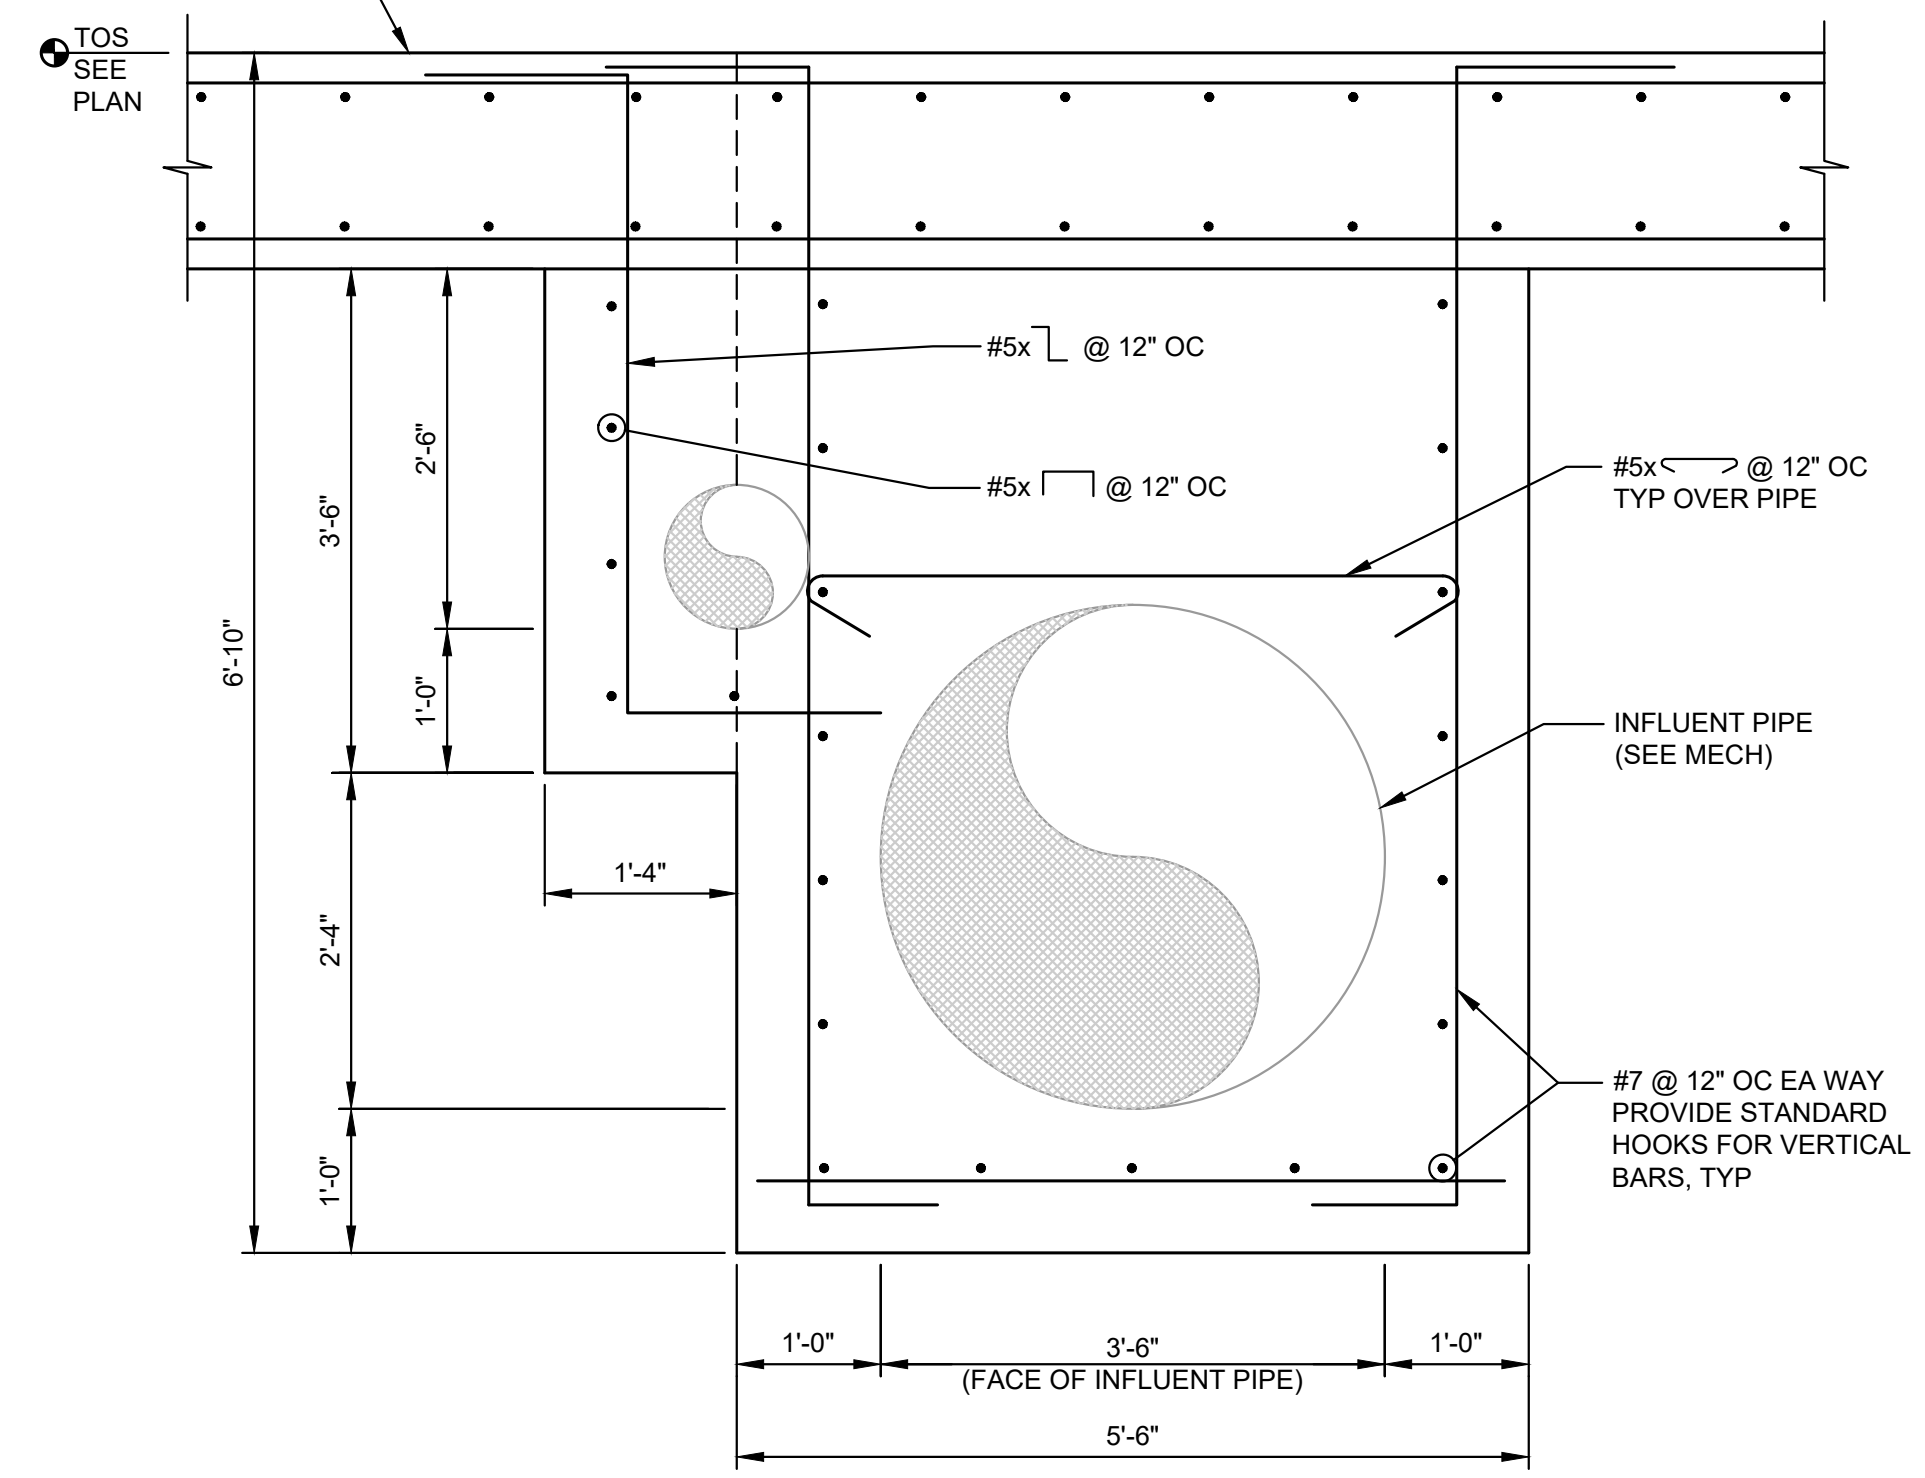

SECTION D
SCALE: 3/4"=1'-0"

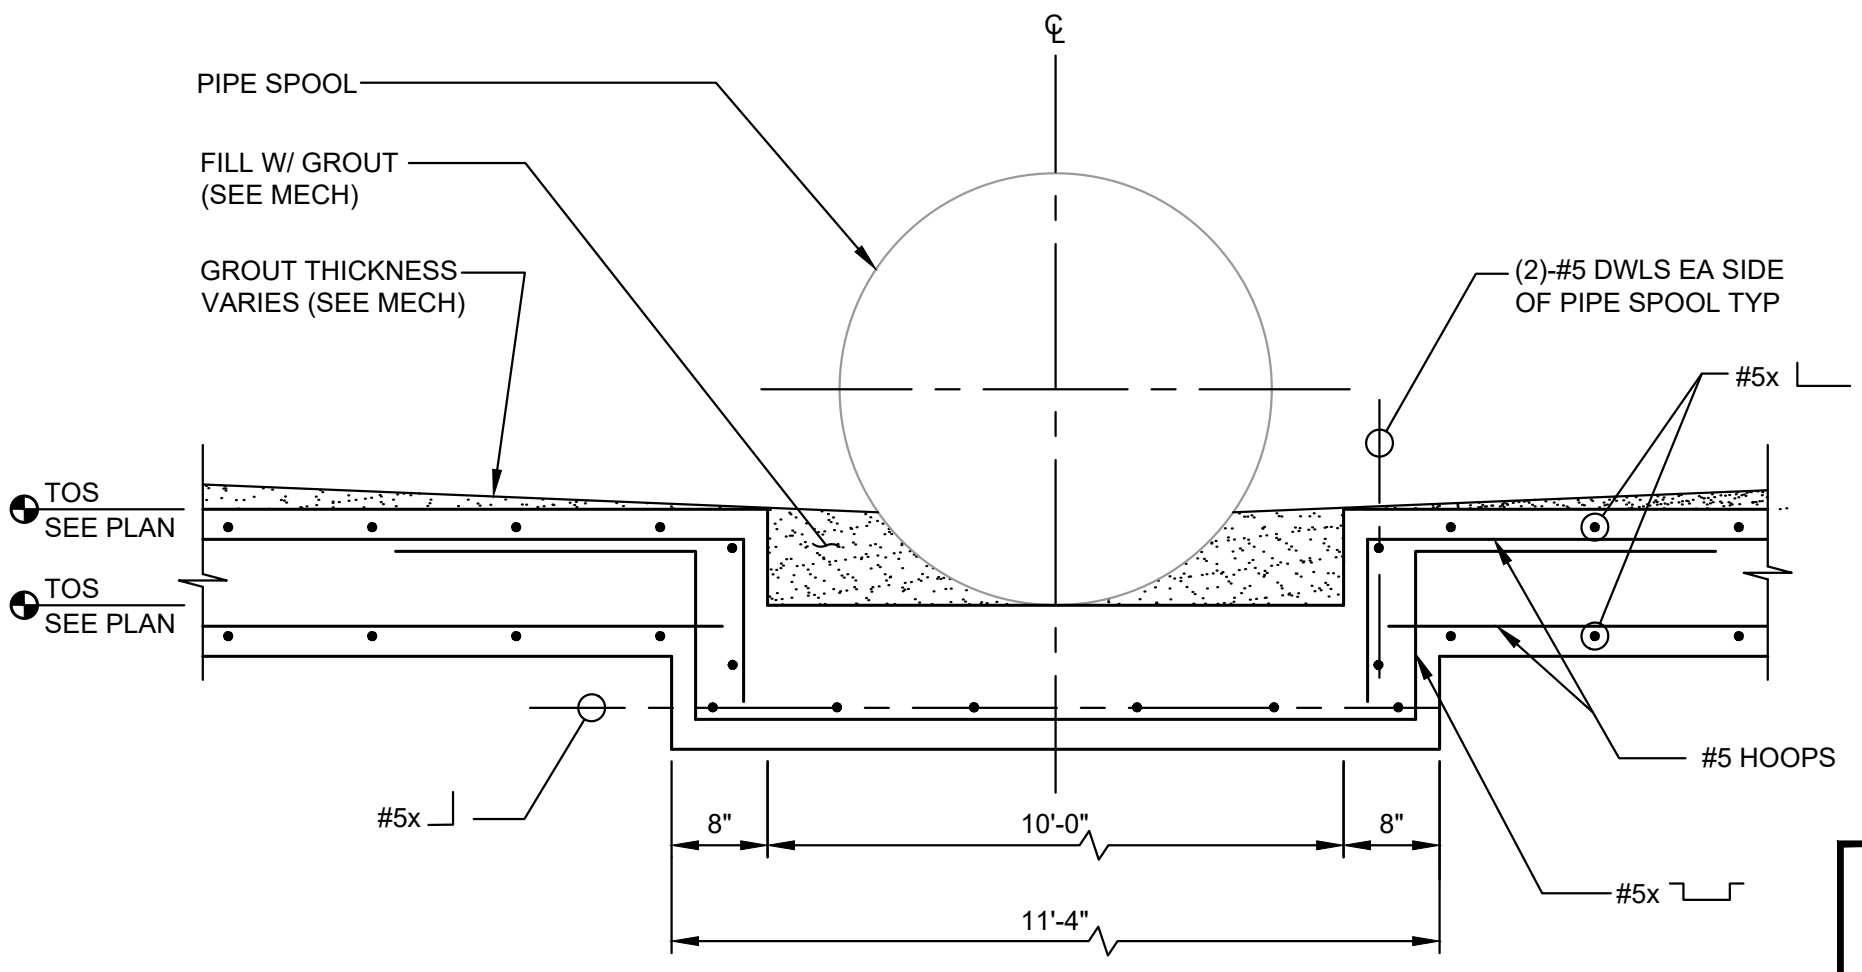

SECTION E
SCALE: 3/4"=1'-0"

APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED DATE: _____
EXPIRATION DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

m:\PUYALLUP\21462\wpcp\3rd\secondary clarifier\01 design\plan\set\Structural\S7_SC3_PLN.dwg, 1/3/2022 2:39 PM, CHARLEY REID

Z:\J\05\G&O\21462\Cad\21462_E1.DWG, 1/31/2022 2:39 PM, DAVE A. BOWMAN

ELECTRICAL GENERAL NOTES

GO1 IN GENERAL, DEVICES SHOWN ON THE ELECTRICAL DRAWINGS IN BACKGROUND (GRAY OR SCREENED) REPRESENT ONE OF THE FOLLOWING UNLESS NOTED OTHERWISE ON AN INDIVIDUAL SHEET:
• STRUCTURAL OR ARCHITECTURAL BUILDING STRUCTURES SUCH AS WALLS, DOORS, STAIRS, ETC. AND STRUCTURAL FRAMING MEMBERS.
• MECHANICAL EQUIPMENT OR DEVICES SUCH AS HVAC UNITS AND PROCESS EQUIPMENT WHICH ARE SHOWN ON THE MECHANICAL DRAWINGS AND ARE SHOWN IN BACKGROUND (GRAY OR SCREENED) ON THE ELECTRICAL DRAWINGS TO ASSIST IN DETERMINING THE LOCATION OF THE EQUIPMENT, CONNECTIONS AND DEVICES.
• DISTRIBUTION EQUIPMENT SHOWN ON ELECTRICAL PLAN DRAWINGS (SUCH AS LIGHTING PLANS) IS SHOWN IN BACKGROUND (GRAY OR SCREENED) IN ORDER TO CLARIFY OTHER ELECTRICAL DEVICES AND CIRCUITS SHOWN ON THAT SHEET.
• EQUIPMENT OR DEVICES THAT ARE EXISTING TO REMAIN (AND TO BE PRESERVED AND PROTECTED) WHERE SHOWN ON REVISED/MODIFICATIONS ELECTRICAL SHEETS.
GO2 THE EXISTING FUNCTION OF THE TREATMENT PLANT TO TREAT AND DISINFECT SEWAGE ARE TO REMAIN IN OPERATION AT ALL TIMES. IT IS THE CONTRACTOR'S RESPONSIBILITY TO COORDINATE THE WORK OF THE CONSTRUCTION PROCESS AND, TO ENSURE THAT ALL TREATMENT FUNCTIONS REMAIN IN OPERATION DURING THE COURSE OF CONSTRUCTION, INCLUDING PROVIDING BYPASS PUMPING OR OTHER MEANS. FOR ITEMS THAT ARE SHOWN TO BE DEMOLISHED, THEY SHALL REMAIN IN OPERATION UNTIL NO LONGER REQUIRED FOR THE OPERATION OF THE TREATMENT PROCESS.
GO3 THE ELECTRICAL EQUIPMENT, MATERIALS, DEVICES AND CIRCUITS SHOWN ON THESE DRAWINGS ARE EXISTING TO REMAIN UNLESS OTHERWISE NOTED AS BEING DEMOLISHED OR MODIFIED. THE CONTRACTOR SHALL COORDINATE NEW CONDUIT AND CIRCUIT ROUTING AND ELEVATIONS WITH EXISTING EQUIPMENT, MATERIALS, DEVICES AND CIRCUITS PRIOR TO INSTALLATION. PROVIDE ALL MEANS NECESSARY TO PRESERVE, PROTECT AND KEEP EXISTING EQUIPMENT, MATERIALS, DEVICES AND ELECTRICAL CIRCUITS IN OPERATION DURING THE COURSE OF CONSTRUCTION INCLUDING PROVIDING TEMPORARY CIRCUITS TO ALLOW THEM TO REMAIN IN OPERATION AT ALL TIMES. THE INFORMATION SHOWN FOR EXISTING EQUIPMENT, MATERIALS AND UNDERGROUND OR CONCEALED ELECTRICAL CIRCUITS IS BASED ON AVAILABLE RECORD INFORMATION AND ON SITE SURVEY OF EXPOSED CIRCUITS, AND IS PROVIDED FOR INFORMATION ONLY. PRIOR TO COMMENCING NEW ELECTRICAL WORK OR TRENCHING, VERIFY LOCATIONS AND CONTENTS OF EXISTING EQUIPMENT, MATERIALS, DEVICES AND EXPOSED, CONCEALED OR UNDERGROUND CIRCUITS IN FIELD (BY TONING, X-RAY, EXCAVATION POTHOLING OR OTHER MEANS).
GO4 THE DRAWINGS ARE NOT INTENDED TO SHOW ALL OF THE EXISTING CONDITIONS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VISIT THE SITE AND REVIEW EXISTING CONDITIONS PRIOR TO BIDDING. WHERE EXISTING CONDITIONS DIFFER FROM THOSE SHOWN TO THE EXTENT IT WILL IMPACT THE COST OF THE CONTRACTOR'S WORK, THE CONTRACTOR SHALL NOTIFY THE OWNER IN WRITING A MINIMUM OF 10 DAYS PRIOR TO BIDDING.
GO5 THERE ARE EXISTING AND NEW PROCESS PIPING AND EQUIPMENT INSTALLED/TO BE INSTALLED ON THIS SITE. THE CONTRACTOR SHALL COORDINATE NEW CONDUIT AND CIRCUIT ROUTING AND ELEVATIONS WITH EXISTING EQUIPMENT, PIPING, AND OTHER CONSTRUCTION ACTIVITIES PRIOR TO INSTALLATION. LOCATE EXISTING UNDERGROUND FACILITIES, PRESERVE AND PROTECT THEM DURING CONSTRUCTION AND ROUTE NEW CONDUITS TO AVOID CONFLICTS BY INSTALLING AT DIFFERENT LEVELS OR WHEN APPROVED BY THE ENGINEER, DIFFERENT ROUTING.
GO6 EXISTING EQUIPMENT, MATERIALS, DEVICES AND CIRCUITS DAMAGED DURING THE COURSE OF CONSTRUCTION SHALL BE IMMEDIATELY REPLACED WITH NEW EQUIPMENT, MATERIALS, DEVICES AND CIRCUITS OF LIKE MATERIALS AT NO ADDITIONAL COST TO THE OWNER.
GO7 DEMOLISH EXISTING EQUIPMENT, MATERIALS AND DEVICES SHOWN CROSS HATCHED AND AS INDICATED UNLESS OTHERWISE NOTED. REMOVE CONDUIT (EXCEPT CONCEALED OR UNDERGROUND CONDUIT AS NOTED BELOW), FITTINGS, HANGERS, CONDUCTORS, DEVICE/JUNCTION BOXES, AND SIMILAR ITEMS ASSOCIATED WITH ITEM NOTED, BACK TO NEXT DEVICE REMAINING ON THE CIRCUIT OR BACK TO THE PANEL/MCC UNIT FROM WHICH THE CIRCUIT ORIGINATES. WHERE DEVICE BEING REMOVED IS IN THE MIDDLE OF A CIRCUIT, REPLACE/REPAIR CIRCUIT AS REQUIRED TO KEEP REMAINING DEVICES ON CIRCUIT IN OPERATION.
ABANDON-IN-PLACE UNUSED CONDUITS CONCEALED IN SLAB, OR UNDERGROUND BELOW SLAB OR BELOW GRADE, CUT EXPOSED PORTION FLUSH WITH SLAB, OR 12" BELOW GRADE, AND PLUG WITH NON-SHRINK GROUT. CUT, PATCH, REPAIR AND PAINT EXISTING WALLS/Ceilings AS REQUIRED TO REMOVE EXISTING DEVICES/EQUIPMENT. LEGALLY DISPOSE OF MATERIAL/EQUIPMENT WHICH ARE REMOVED.
GO8 SALVAGE EQUIPMENT, MATERIALS AND DEVICES TO OWNER PER REQUIREMENTS OF DIVISION 1, SECTION 01900 UNLESS OTHERWISE NOTED ON DRAWINGS.
GO9 COORDINATE CONDUIT STUB UP LOCATIONS WITH APPROVED EQUIPMENT SHOP DRAWING SUBMITTALS PRIOR TO LOCATING CONDUIT STUB UPS IN THE SLAB. LOCATE CONDUIT STUB UPS PER EQUIPMENT MANUFACTURER'S RECOMMENDATIONS AND THE REQUIREMENTS OF THE DRAWINGS AND SPECIFICATIONS.

GENERAL ELECTRICAL ACRONYMS AND ABBREVIATIONS

Table with 2 columns: Acronym and Description. Includes terms like AMPERE, ALTERNATING CURRENT, AVAILABLE FAULT CURRENT, ABOVE FINISHED FLOOR, etc.

ELEMENTARY WIRING DIAGRAMS SYMBOL SCHEDULE

Table with 3 columns: SYMBOL, DESCRIPTION, and LENS COLOR CODE. Includes symbols for PANEL OR DEVICE WIRING, FIELD WIRING, EQUIPMENT/DEVICE ENCLOSURE, CONTACTBLOCK OPERATORS, CONTACTS, RELAY CONTACTS, MECHANICALLY ACTUATED SWITCHES, MAGNETIC COILS, and PILOT LIGHTS.

ONE LINE DIAGRAMS SYMBOL SCHEDULE

Table with 2 columns: SYMBOL and DESCRIPTION. Includes symbols for DEVICE OR EQUIPMENT TERMINAL, WIRING CONNECTED, BUS, WIRING, EQUIPMENT/DEVICE ENCLOSURE, PLUG-IN CONNECTION, NON-AUTOMATIC BREAKER, THERMAL MAGNETIC CIRCUIT BREAKER, MAGNETIC ONLY CIRCUIT BREAKER (MOTOR CIRCUIT PROTECTOR), SWITCH, CONTACTOR, THERMAL OVERLOAD, FUSE, POWER TRANSFORMER, CONTROL POWER TRANSFORMER, CURRENT TRANSFORMER, CAPACITOR, GROUND CONNECTION, TRANSFER SWITCH, WATTHOUR METER (REVENUE METERING), VOLTAGE RELAY, GENERATOR, TAP BLOCK, SOLID NEUTRAL, MOTOR, LIMIT SWITCH, FLOAT SWITCH, PRESSURE SWITCH, THERMOSTAT/TEMPERATURE SWITCH, SOLENOID VALVE, TORQUE SWITCH, CONTROL STATION/PUSHBUTTON/SPEED POTENTIOMETER, LOAD BREAK FUSE HOLDER AND FUSE, SAFETY DISCONNECT (NEMA 4X ENCLOSURE UNLESS OTHERWISE NOTED), AUXILIARY CONTACT NON-SWITCHED CONDUCTOR, KIRK KEY, INTERLOCK.

ELECTRICAL PLAN DRAWINGS SYMBOL SCHEDULE

Table with 2 columns: SYMBOL and DESCRIPTION. Includes symbols for POWER DISTRIBUTION AND CONTROL (FLOOR MOUNTED, WALL MOUNTED), PANELBOARD - WALL MOUNTED, SWITCH (SAFETY OR DISCONNECT), SWITCH (FUSIBLE), LIGHTING FIXTURES (FLUORESCENT LED LINEAR FIXTURE), SWITCHING (SINGLE POLE SWITCH - WALL MOUNTED), RECEPTACLE OUTLETS (DUPLEX, QUADRUPLEX, SPECIAL PURPOSE), SPECIAL PURPOSE CONNECTIONS (EQUIPMENT, WALL MOUNTED), ELECTRICAL DEVICES (SOLENOID VALVE, MOTOR, PUSH BUTTON CONTROL), MECHANICALLY ACTUATED SWITCHES (FLOAT, LEVEL TRANSDUCER, PRESSURE, PHOTO ELECTRIC, LIMIT), GENERAL WIRING SYMBOLS (JUNCTION BOX, WIRING RUN EXPOSED, CONCEALED, INDICATES WIRE SIZE, LINE OR PHASE CONDUCTOR, NEUTRAL CONDUCTOR, GROUNDING CONDUCTOR, ARROWHEAD INDICATES HOMERUN, CONDUIT TURN UP/DOWN).

DESIGNATIONS
A,B,C,ETC. ARE FIXTURE TYPE. REFER TO LIGHTING FIXTURE SCHEDULE
a,b,c,ETC. ARE SWITCHING CONTROL REFERENCE
DESIGNATIONS
1,2,3,ETC. ARE CIRCUIT NUMBERS OF PANELBOARD TO WHICH OUTLET IS TO BE CONNECTED. REFER TO CIRCUIT SCHEDULE
WP = WEATHERPROOF
GFCI = GROUND FAULT CIRCUIT INTERRUPTER

APPROVED
BY: CITY ENGINEER
CITY OF PUYALLUP
APPROVED DATE:
EXPIRATION DATE:
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans. Field conditions may dictate changes to these plans as determined by the City Engineer.


Gray & Osborne, Inc. CONSULTING ENGINEERS
1130 RAINIER AVENUE SOUTH, SUITE 300
SEATTLE, WASHINGTON 98144
(206) 284-0860



CITY OF PUYALLUP
WATER POLLUTION CONTROL PLANT THIRD SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW, PUYALLUP, WA 98371


PRELIMINARY NOT FOR CONSTRUCTION

Table with 3 columns: No., DATE, REVISION. Includes ISSUED FOR: 90% DESIGN REVIEW, ISSUE DATE: DECEMBER 2021, APPROVED BY: DAB, CHECKED BY: DAB, DRAWN BY: DEK, DESIGNER: DAB, G & O JOB NO.: 21462, FILE: 21462_E1.DWG

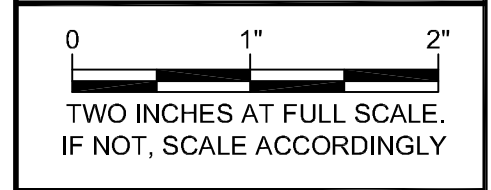

ELECTRICAL


SYMBOL SCHEDULE AND GENERAL NOTES



**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION

ISSUED FOR:	90% DESIGN REVIEW
ISSUE DATE:	DECEMBER 2021
APPROVED BY:	DAB
CHECKED BY:	DAB
DRAWN BY:	DEK
DESIGNER:	DAB
G & O JOB NO.:	21462
FILE:	21462_E2.DWG



ELECTRICAL

APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP

APPROVED
DATE: _____
EXPIRATION
DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.


The City will not be responsible for errors and/or omissions on these plans. Field conditions may dictate changes to these plans as determined by the City Engineer.

**MCC ELEVATIONS
AND SCHEDULES**


NOTES:

SEE DRAWING E-1 FOR GENERAL NOTES AND FOR GENERAL PLAN NOTES.

- REPLACE EXISTING MCC VFD UNIT WITH NEW VFD UNIT. PROVIDE NEW DOOR WITH NEW UNIT.
- REPLACE EXISTING MCC LINE REACTOR UNIT WITH NEW LINE REACTOR UNIT. PROVIDE NEW DOOR WITH NEW UNIT. ALTERNATIVELY, EXISTING MCC LINE REACTOR UNIT MAY BE REUSED IF COMPATIBLE WITH NEW VFD UNIT.
- PROVIDE NEW MCC FVNR STARTER UNIT IN EXISTING MCC SPACE. PROVIDE NEW DOOR WITH NEW UNIT.
- PRESERVE EXISTING CONTROL WIRING FROM THE PLC AND REMOTE IO UNITS TO THE MCC VFD UNITS FOR RECONNECTION TO THE NEW MCC UNITS. SEE SHEETS E-3 AND E-4 FOR ADDITIONAL INFORMATION.
- PROVIDE NEW SPLIT BUCKET MCC-UNIT WITH TWO 3P-20A BRANCH CIRCUIT BREAKERS.
- EXISTING MCC IS A SQUARE D MODEL 6 ORIGINALLY BUILT IN 1998.

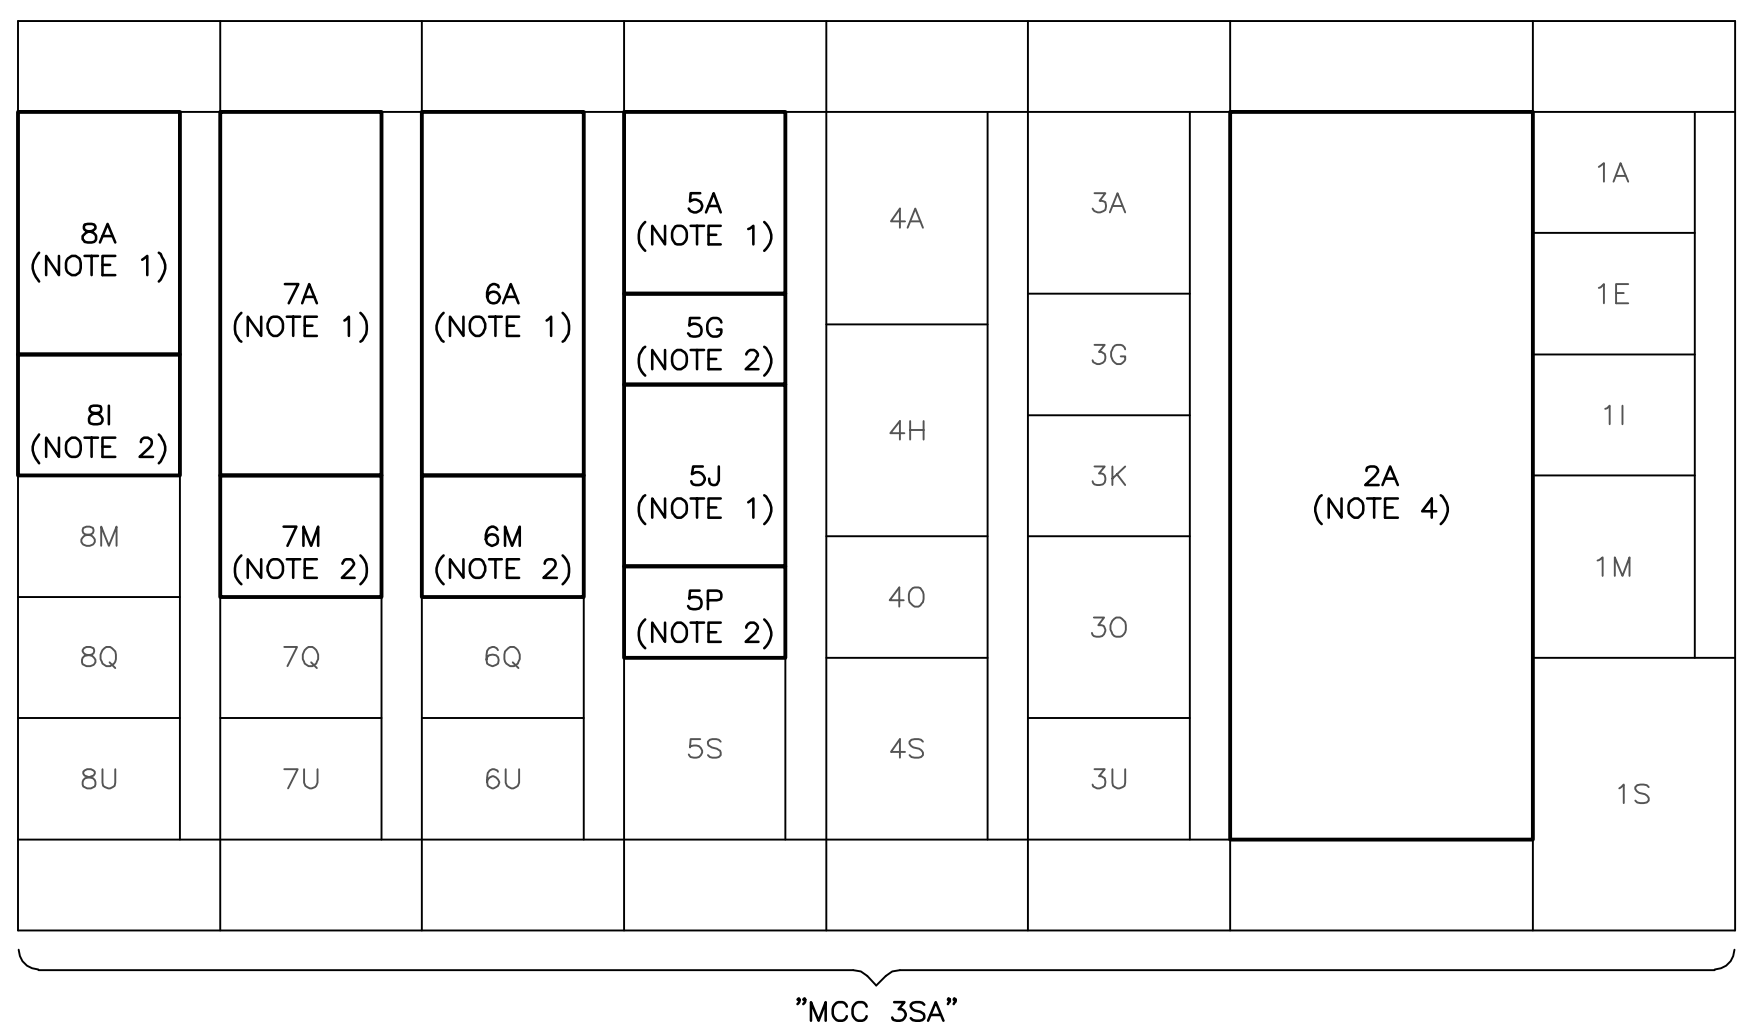

**ELEVATION
MOTOR CONTROL CENTER "MCC 3SA"**
SCALE: 1/2"=1'-0"
(NOTE 6)

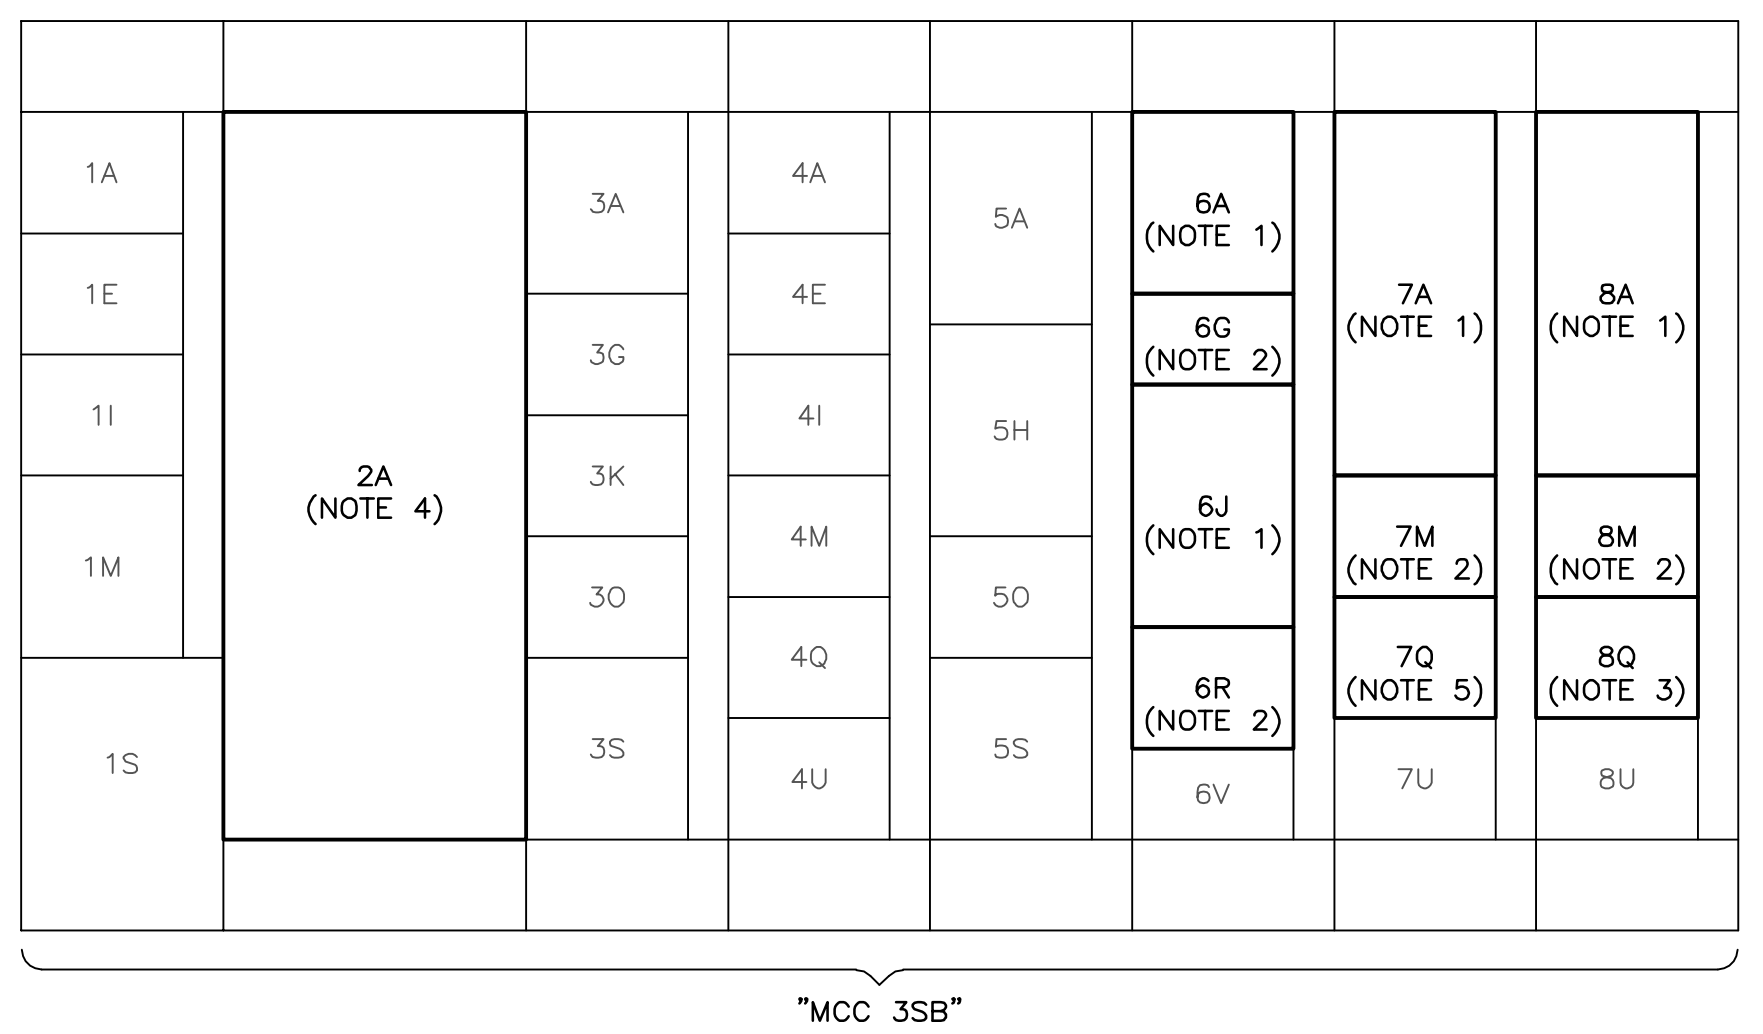


**ELEVATION
MOTOR CONTROL CENTER "MCC 3SB"**
SCALE: 1/2"=1'-0"
(NOTE 6)

MOTOR CONTROL CENTER
CIRCUIT SCHEDULE
"MCC 3SA"

SEC.	UNIT	DESCRIPTION (NAMEPLATE)	TAG I.D.	O.L.D. # / SHEET #	E.W.D. # / SHEET #	
1	A	RAS BUILDING JIB CRANE	06 JC 01	N/A	N/A	
1	E	SPACE	N/A	N/A	N/A	
1	I	SPACE	N/A	N/A	N/A	
1	M	SPACE	N/A	N/A	N/A	
1	S	MAIN LUGS	N/A	N/A	N/A	
2	A	PLC "MCC 3SA"	N/A	N/A	N/A	(NOTE 4)
3	A	NON-POTABLE WATER PUMP #1	08 P 01	N/A	N/A	
3	G	SPACE	N/A	N/A	N/A	
3	K	SPACE	N/A	N/A	N/A	
3	O	SPACE	N/A	N/A	N/A	
3	U	SPACE	N/A	N/A	N/A	
4	A	EFFLUENT PUMP #1	08 EP 01	N/A	N/A	
4	H	EFFLUENT PUMP #3	08 EP 03	N/A	N/A	
4	O	EFFLUENT PUP NO.1 HEATER	N/A	N/A	N/A	
4	S	EFFLUENT PUP NO.3 HEATER	N/A	N/A	N/A	
5	A	SECONDARY CLARIFIER #1	07 SCH 01	O.L.D. 4/E-4	E.W.D. 2/E-4	(NOTE 1)
5	G	SECONDARY CLARIFIER #1 LINE REACTOR	N/A	N/A	N/A	(NOTE 2)
5	J	SECONDARY CLARIFIER #3	07 SCH 03	O.L.D. 3/E-4	E.W.D. 4/E-4	(NOTE 1)
5	P	SECONDARY CLARIFIER #3 LINE REACTOR	N/A	N/A	N/A	(NOTE 2)
5	S	SPACE	N/A	N/A	N/A	
6	A	RAS PUMP #3	06 RP 03	O.L.D. 5/E-4	E.W.D. 1/E-4	(NOTE 1)
6	M	RAS PUMP #3 LINE REACTOR	N/A	N/A	N/A	(NOTE 2)
6	O	SECONDARY CLARIFIER SCUM PUMP NO.1	07 SCP 01	N/A	N/A	
6	U	GENERATOR COOLING FAN	06 RR 01	N/A	N/A	
7	A	RAS PUMP #1	06 RP 01	O.L.D. 5/E-4	E.W.D. 1/E-4	(NOTE 1)
7	M	RAS PUMP #1 LINE REACTOR	N/A	N/A	N/A	(NOTE 2)
7	O	SPACE	N/A	N/A	N/A	
7	U	SPACE	N/A	N/A	N/A	
8	A	WAS PUMP #1	06 WP 01	O.L.D. 6/E-4	E.W.D. 1/E-4	(NOTE 1)
8	I	WAS PUMP #1 LINE REACTOR	N/A	N/A	N/A	(NOTE 2)
8	M	SPACE	N/A	N/A	N/A	
8	O	SPACE	N/A	N/A	N/A	
8	U	SPACE	N/A	N/A	N/A	


MOTOR CONTROL CENTER
CIRCUIT SCHEDULE
"MCC 3SB"

SEC.	UNIT	DESCRIPTION (NAMEPLATE)	TAG I.D.	O.L.D. # / SHEET #	E.W.D. # / SHEET #	
1	A	RAS PUMP HOIST	06 TH 01	N/A	N/A	
1	E	SPACE	N/A	N/A	N/A	
1	I	SPACE	N/A	N/A	N/A	
1	M	SPACE	N/A	N/A	N/A	
1	S	MAIN LUGS	N/A	N/A	N/A	
2	A	REMOTE I/O RACK "MCC 3SB"	N/A	N/A	N/A	(NOTE 4)
3	A	NON-POTABLE WATER PUMP #2	08 P 02	N/A	N/A	
3	G	SPACE	N/A	N/A	N/A	
3	K	SPACE	N/A	N/A	N/A	
3	O	SPACE	N/A	N/A	N/A	
3	S	SPACE	N/A	N/A	N/A	
4	A	SPACE	N/A	N/A	N/A	
4	E	SPACE	N/A	N/A	N/A	
4	I	SPACE	N/A	N/A	N/A	
4	M	SPACE	N/A	N/A	N/A	
4	Q	SPACE	N/A	N/A	N/A	
4	U	SPACE	N/A	N/A	N/A	
5	A	EFFLUENT PUMP #2	08 EP 02	N/A	N/A	
5	H	EFFLUENT PUMP #4	08 EP 04	N/A	N/A	
5	O	EFFLUENT PUP NO.2 HEATER	N/A	N/A	N/A	
5	S	EFFLUENT PUP NO.4 HEATER	N/A	N/A	N/A	
6	A	SECONDARY CLARIFIER #2	07 SCH 02	O.L.D. 4/E-4	E.W.D. 2/E-4	(NOTE 1)
6	G	SECONDARY CLARIFIER #2 LINE REACTOR	N/A	N/A	N/A	(NOTE 2)
6	J	WAS PUMP #2	06 WP 02	O.L.D. 6/E-4	E.W.D. 1/E-4	(NOTE 1)
6	R	WAS PUMP #2 LINE REACTOR	N/A	N/A	N/A	(NOTE 2)
6	V	SPACE	N/A	N/A	N/A	
7	A	RAS PUMP #2	06 RP 02	O.L.D. 5/E-4	E.W.D. 1/E-4	(NOTE 1)
7	M	RAS PUMP #2 LINE REACTOR	N/A	N/A	N/A	(NOTE 2)
7	Q	PUMP ROOM HEATER	06 HT 01	(NOTE 5)	N/A	(NOTE 5)
7	U	SPACE	N/A	N/A	N/A	
8	A	RAS PUMP #4	07 RAS 04	O.L.D. 2/E-4	E.W.D. 3/E-4	(NOTE 1)
8	M	RAS PUMP #4 LINE REACTOR	N/A	N/A	E.W.D. 3/E-4	(NOTE 2)
8	Q	SECONDARY CLARIFIER SCUM PUMP NO.2	07 SCP 02	O.L.D. 1/E-4	E.W.D. 5/E-4	(NOTE 3)
8	U	SPACE	N/A	N/A	N/A	

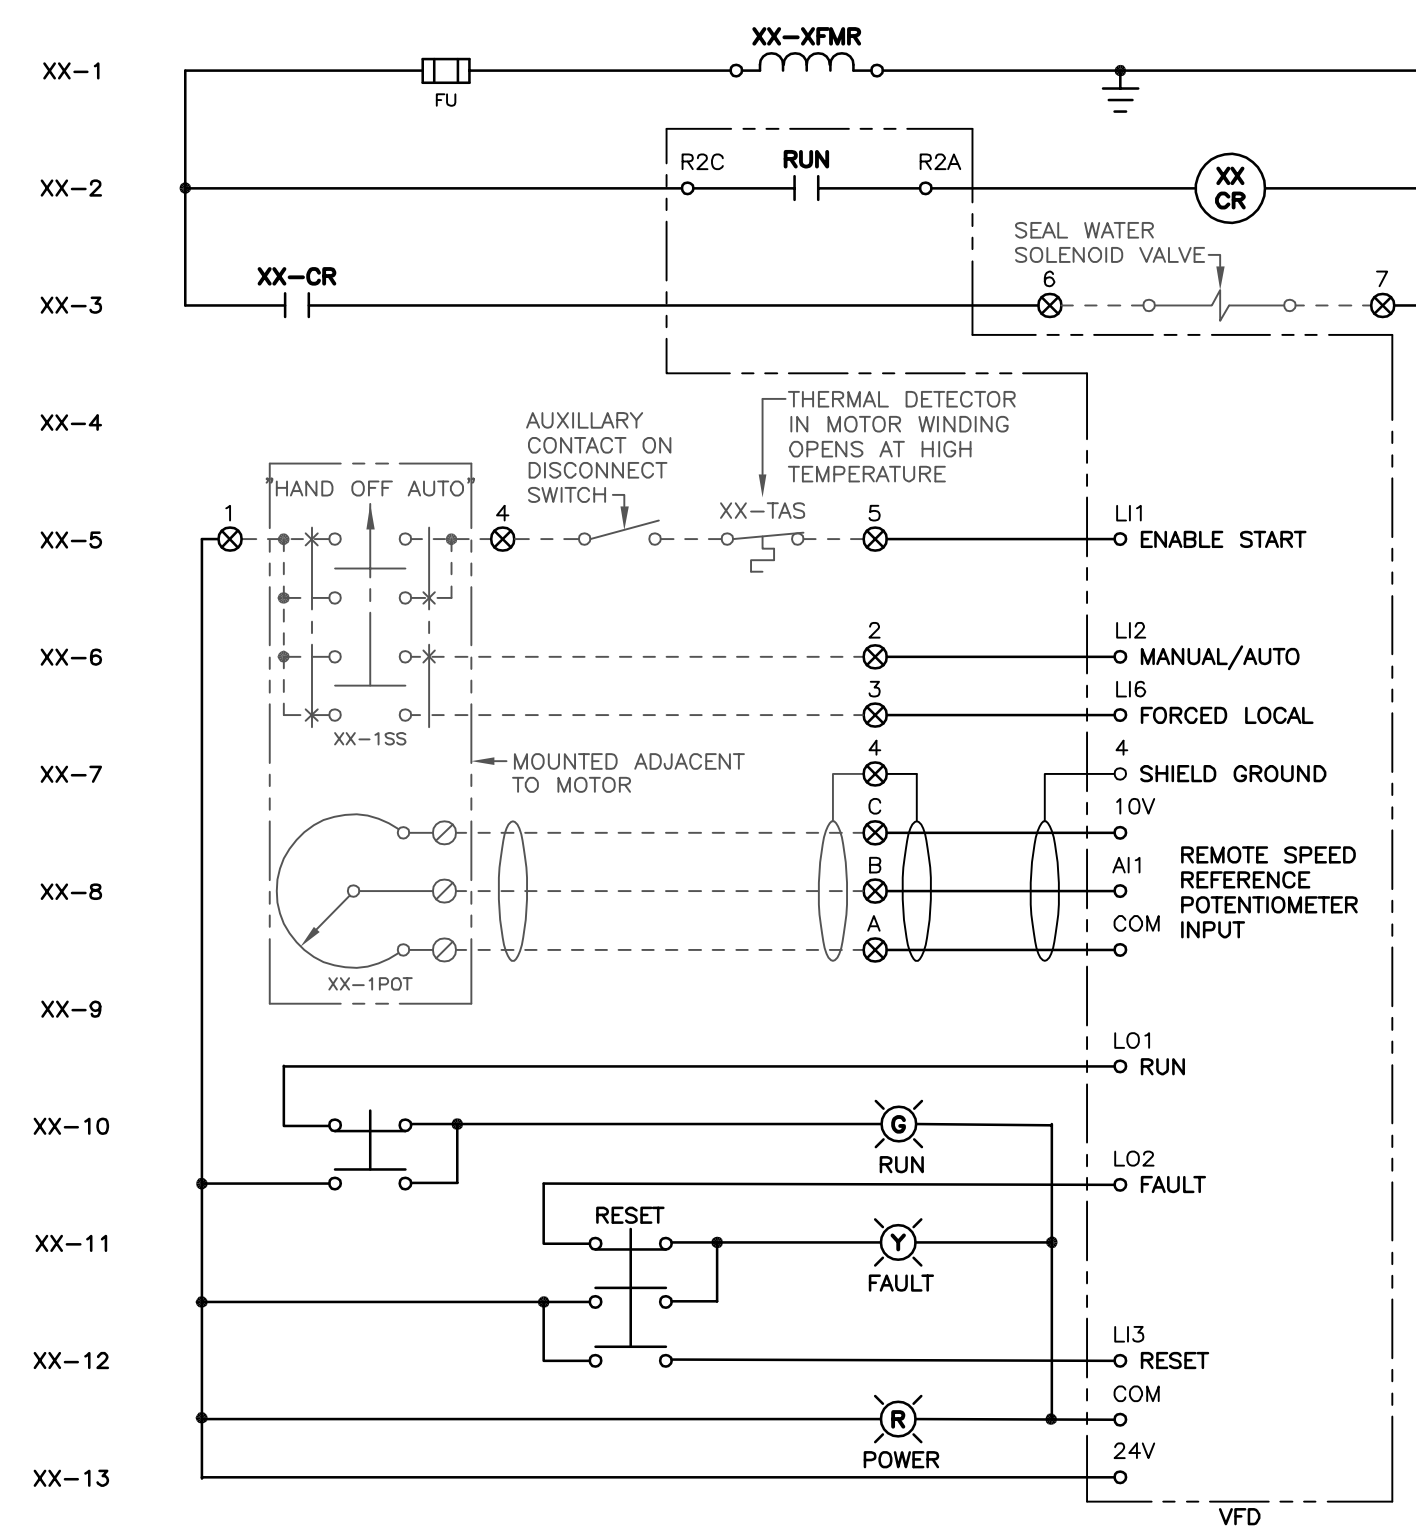

EXISTING E.W.D. 1/E-3

(NOTES 1&2)
 XX = 07 RAS 01, 07 RAS 02, 07 RAS 03,
 XX = 07 WAS 01, 07 WAS 02

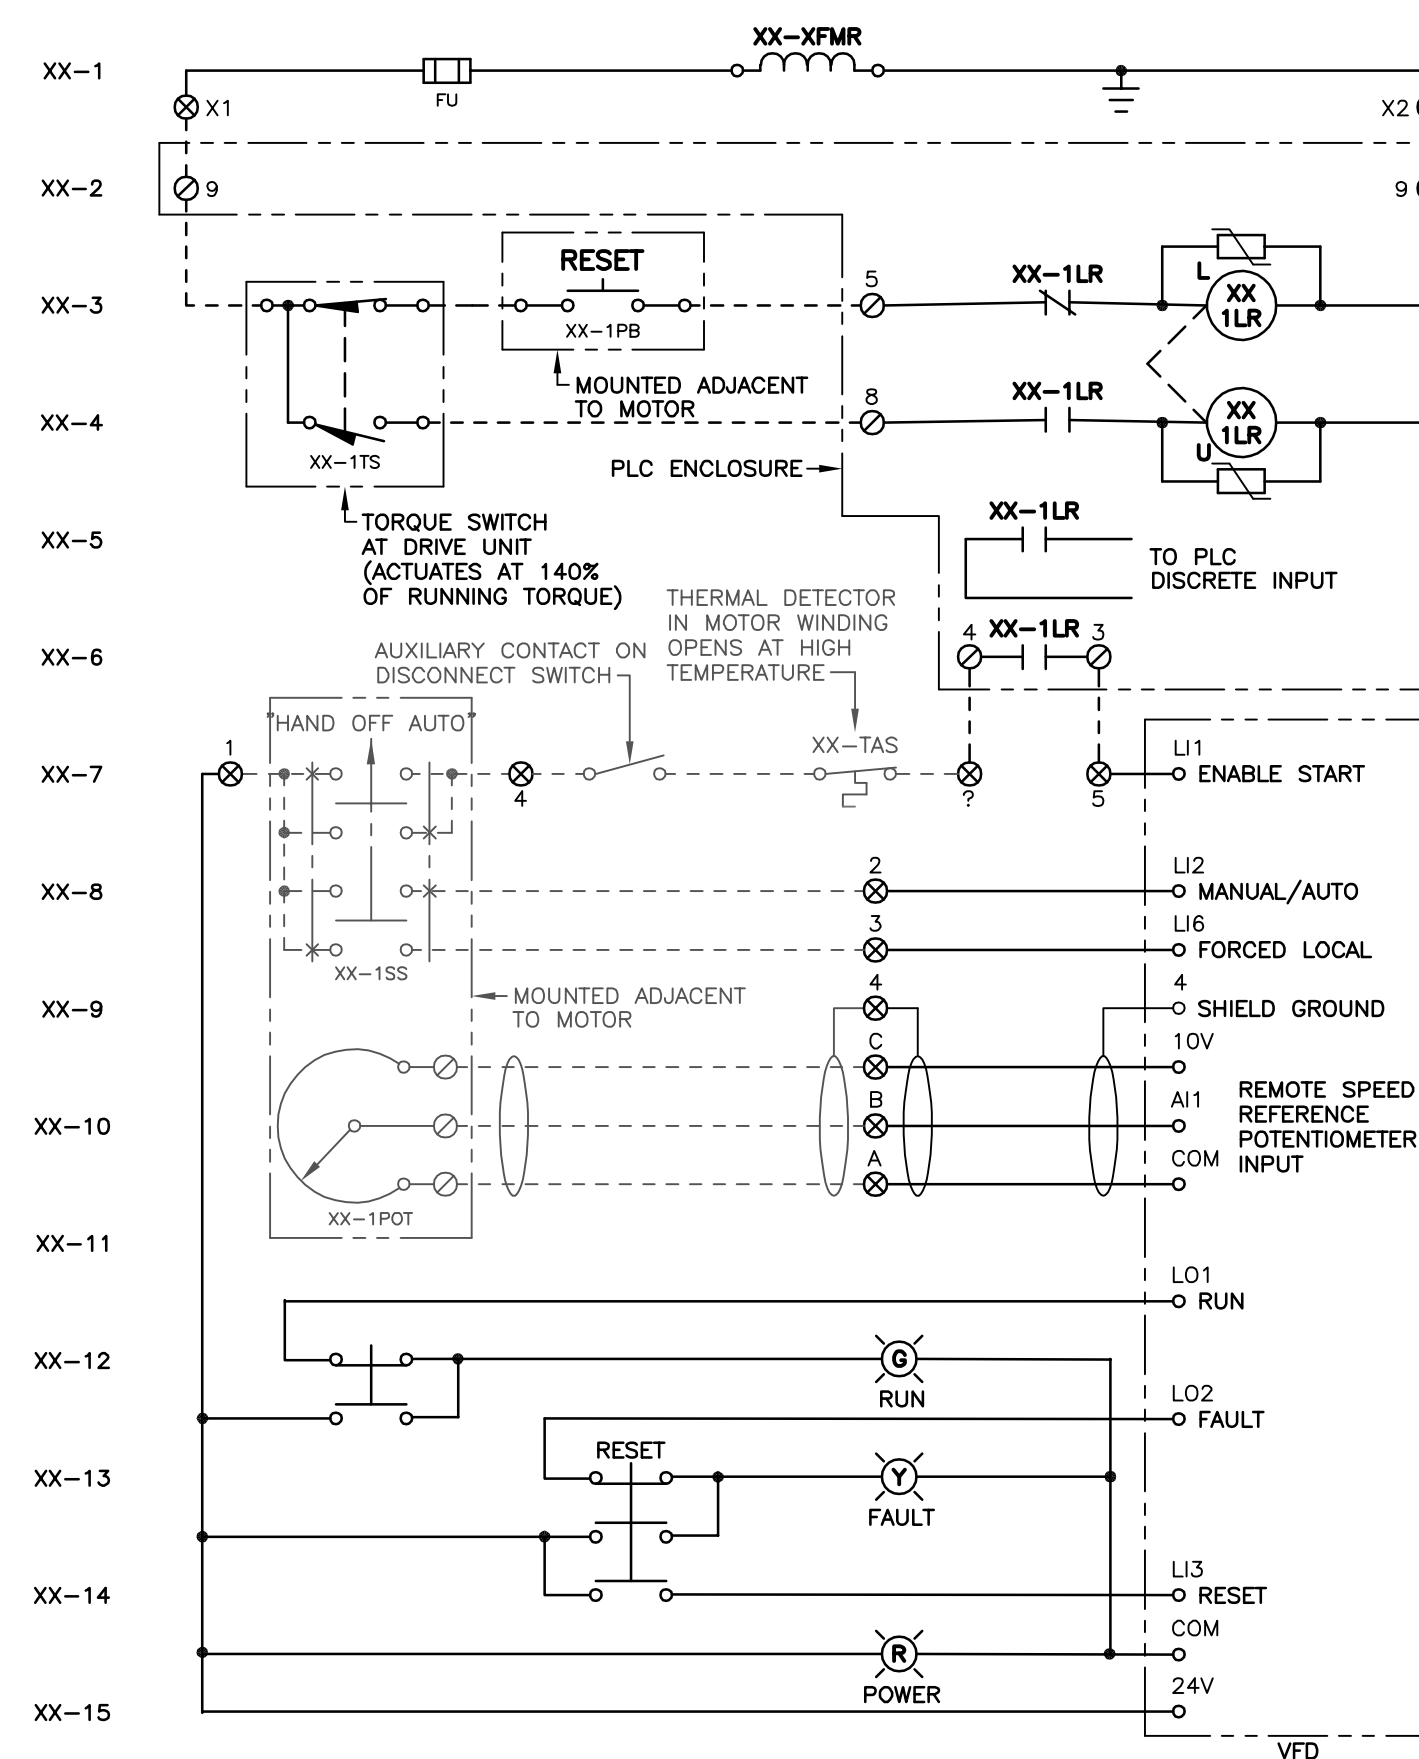

EXISTING E.W.D. 2/E-3

(NOTES 1&2)
 XX = 07 SCM 01, 07 SCM 02

NOTES:

SEE DRAWING E-1 FOR GENERAL NOTES AND FOR GENERAL PLAN NOTES.

1. THIS DIAGRAM DEPICTS THE EXISTING WIRING CONNECTIONS BASED ON THE 1998 RECORD DRAWING AND LIMITED FIELD OBSERVATION. THE OWNER HAS REPLACED SELECTED VFDS SINCE THE ORIGINAL INSTALLATION AND ACTUAL WIRING MAY DIFFER FROM THAT SHOWN. THE CONTRACTOR IS RESPONSIBLE TO DETERMINE THE ACTUAL FIELD AND MCC UNIT WIRING AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES.
2. IDENTIFY AND LABEL ALL FIELD WIRING TERMINATIONS TO FACILITATE DISCONNECTION AND RECONNECTION FOR REPLACEMENT OF THE VFDS. DISCONNECT ALL FIELD WIRING AT MCC VFD UNIT AND PRESERVE FOR RECONNECTION. MAINTAIN ALL FIELD WIRING AT MCC PLC UNIT. REMOVE EXISTING MCC VFD AND LINE REACTOR UNITS TO MAKE SPACE FOR NEW VFD AND LINE REACTOR UNITS. EXISTING LINE REACTOR UNITS MAY BE LEFT IN PLACE AND REUSED IF COMPATIBLE WITH NEW VFD UNITS.



1130 RAINIER AVENUE SOUTH,
 SUITE 300
 SEATTLE, WASHINGTON 98144
 (206) 284-0860




CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
 1602 18TH ST NW,
 PUYALLUP, WA 98371

PRELIMINARY
NOT FOR
CONSTRUCTION

No.	DATE	REVISION

ISSUED FOR:
 90% DESIGN REVIEW
 ISSUE DATE: DECEMBER 2021
 APPROVED BY: DAB
 CHECKED BY: DAB
 DRAWN BY: DEK
 DESIGNER: DAB
 G & O JOB NO.: 21462
 FILE: 21462_E3.DWG

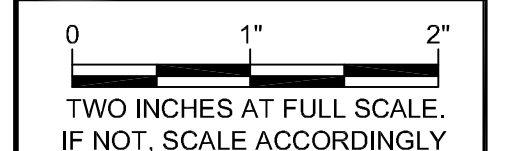

ELECTRICAL

APPROVED

BY: _____
 CITY ENGINEER
 CITY OF PUYALLUP


APPROVED
 DATE: _____
 EXPIRATION
 DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans. Field conditions may dictate changes to these plans as determined by the City Engineer.


EXISTING VFD
E.W.D.S

DRAWING: **E-3** OF: **7**



PRELIMINARY
NOT FOR
CONSTRUCTION

No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: DAB		
CHECKED BY: DAB		
DRAWN BY: DEK		
DESIGNER: DAB		
G & O JOB NO.: 21462		
FILE: 21462_E4.DWG		



ELECTRICAL

APPROVED

BY: _____
CITY ENGINEER
CITY OF PUYALLUP








APPROVED DATE: _____
EXPIRATION DATE: _____

NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans. Field conditions may dictate changes to these plans as determined by the City Engineer.


ONE LINE DIAGRAMS AND E.W.D.S

DRAWING: **E-4** OF: **7**

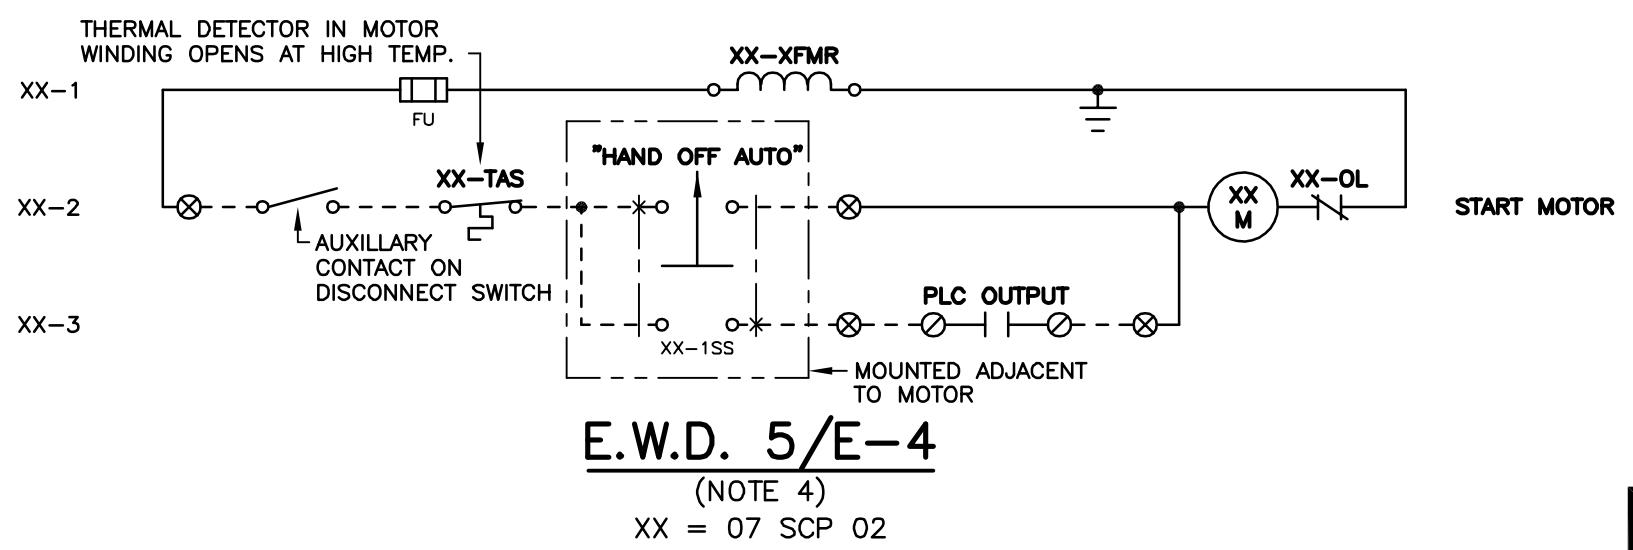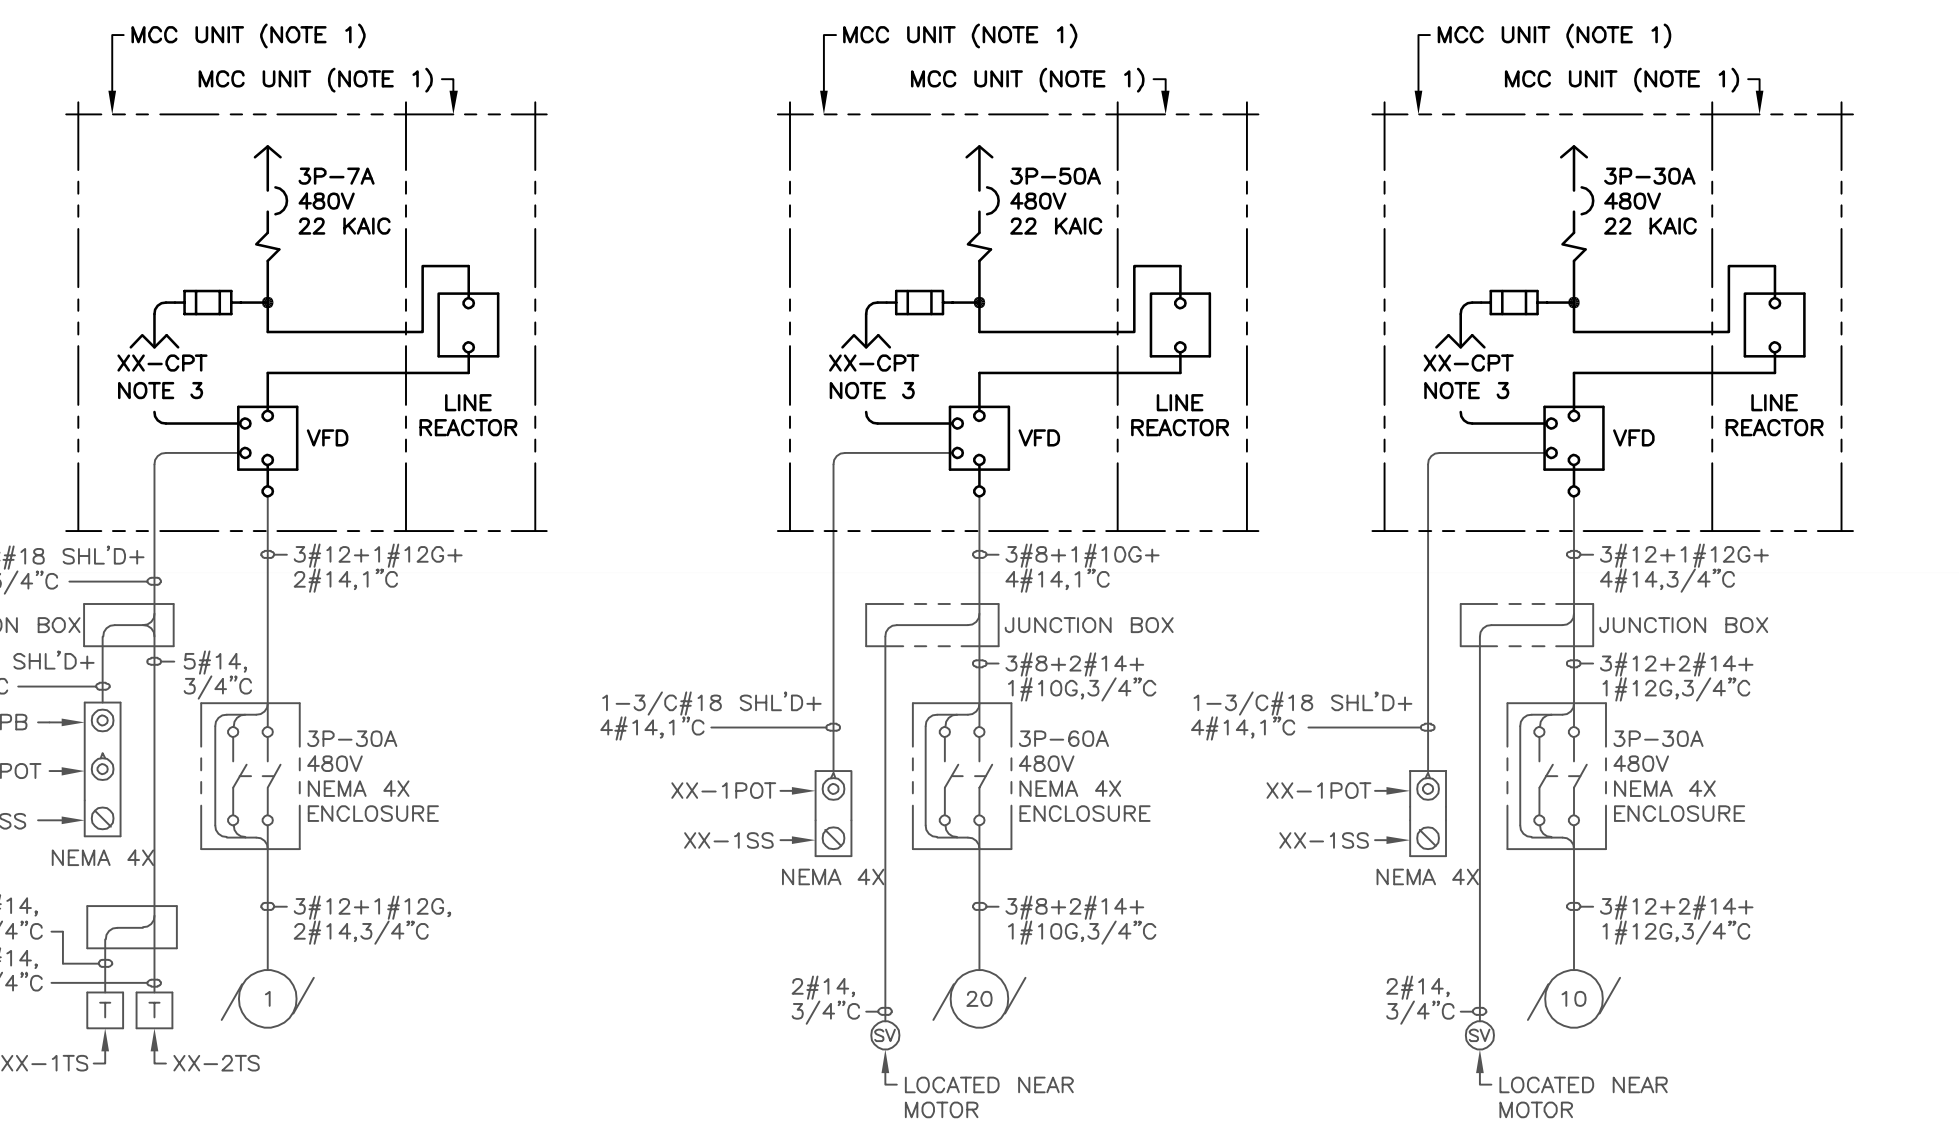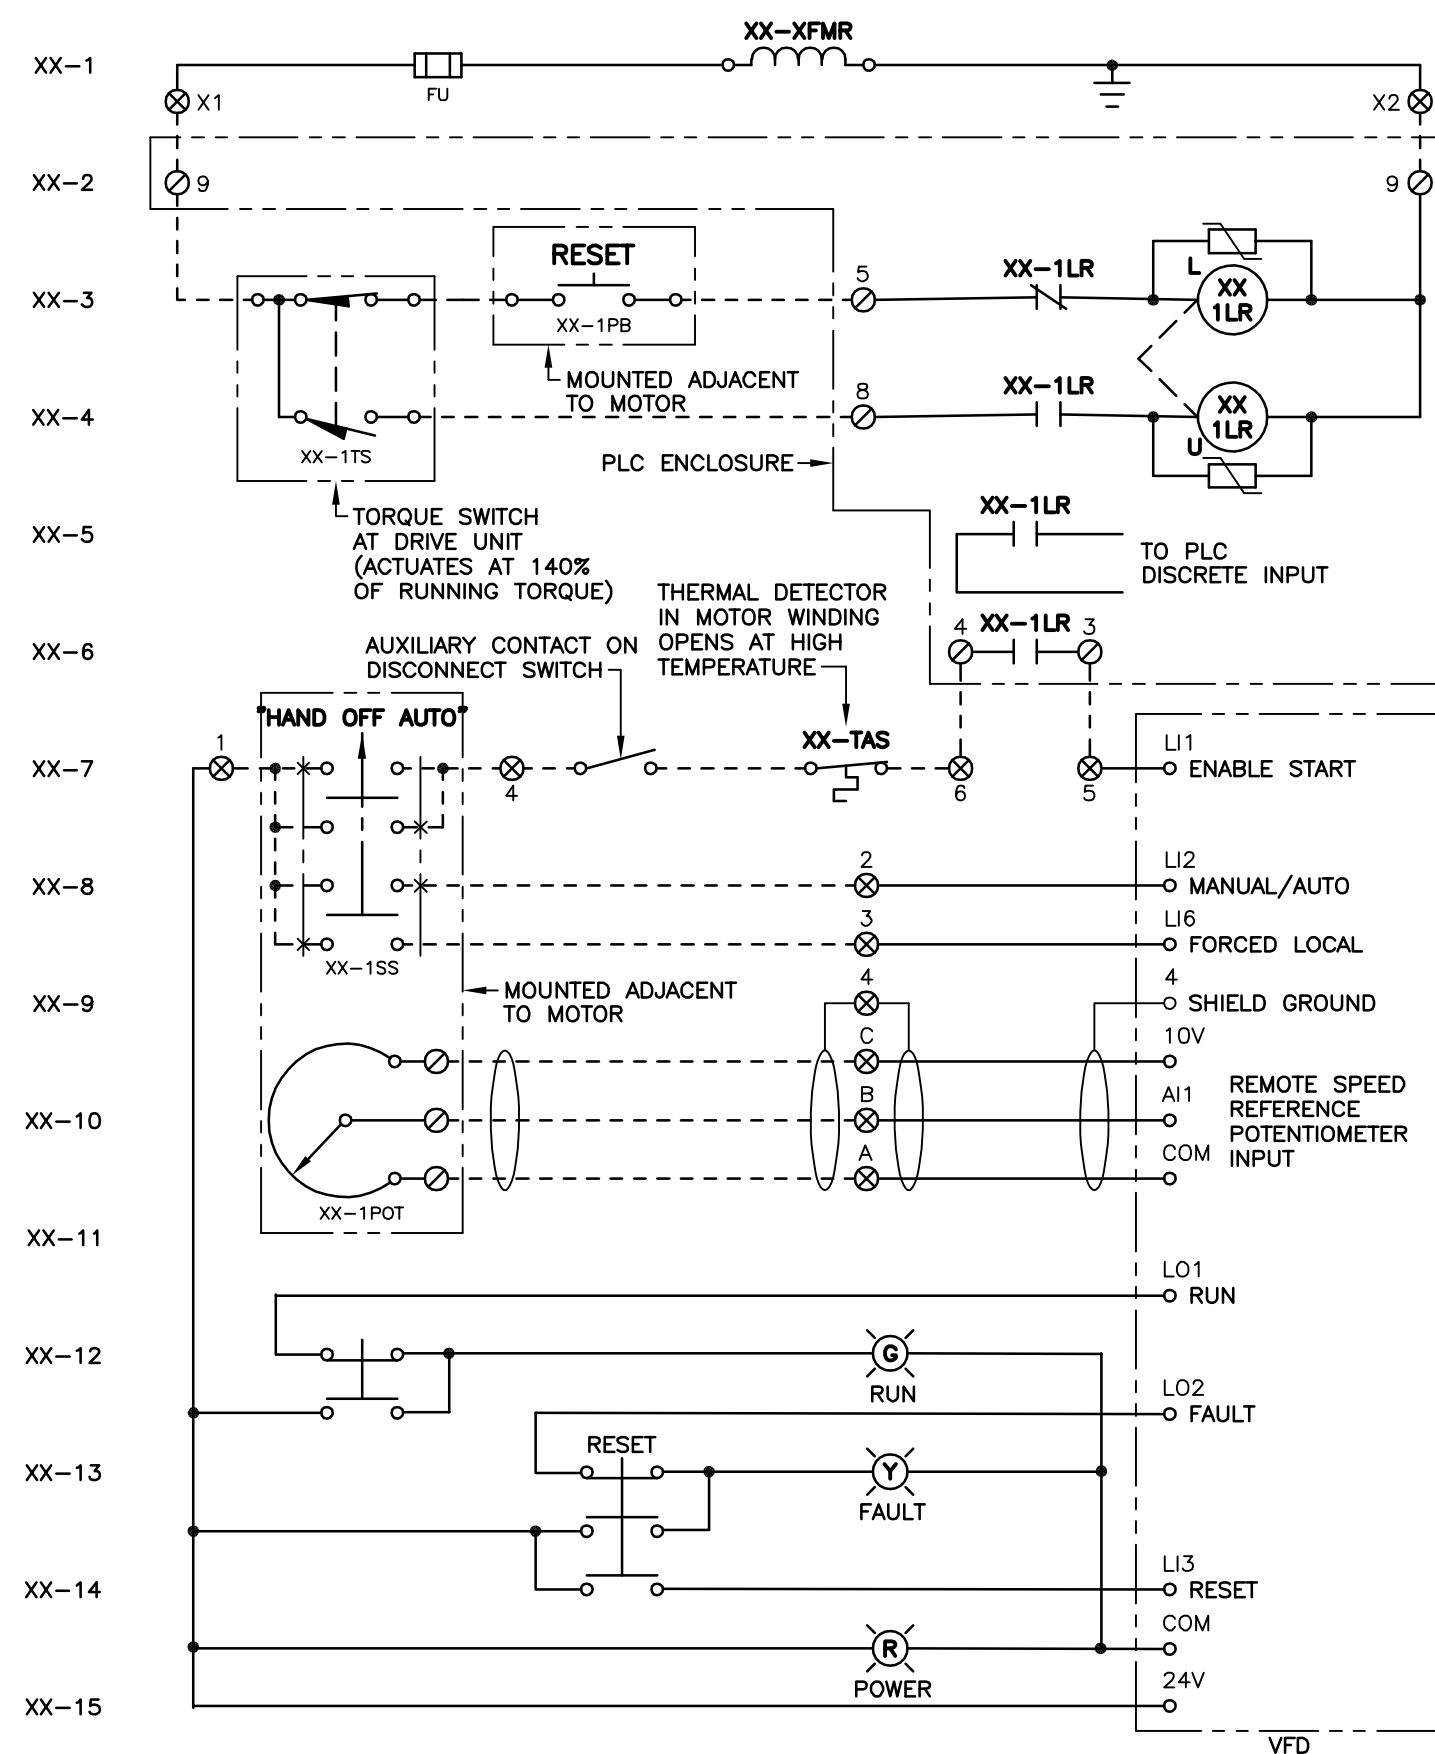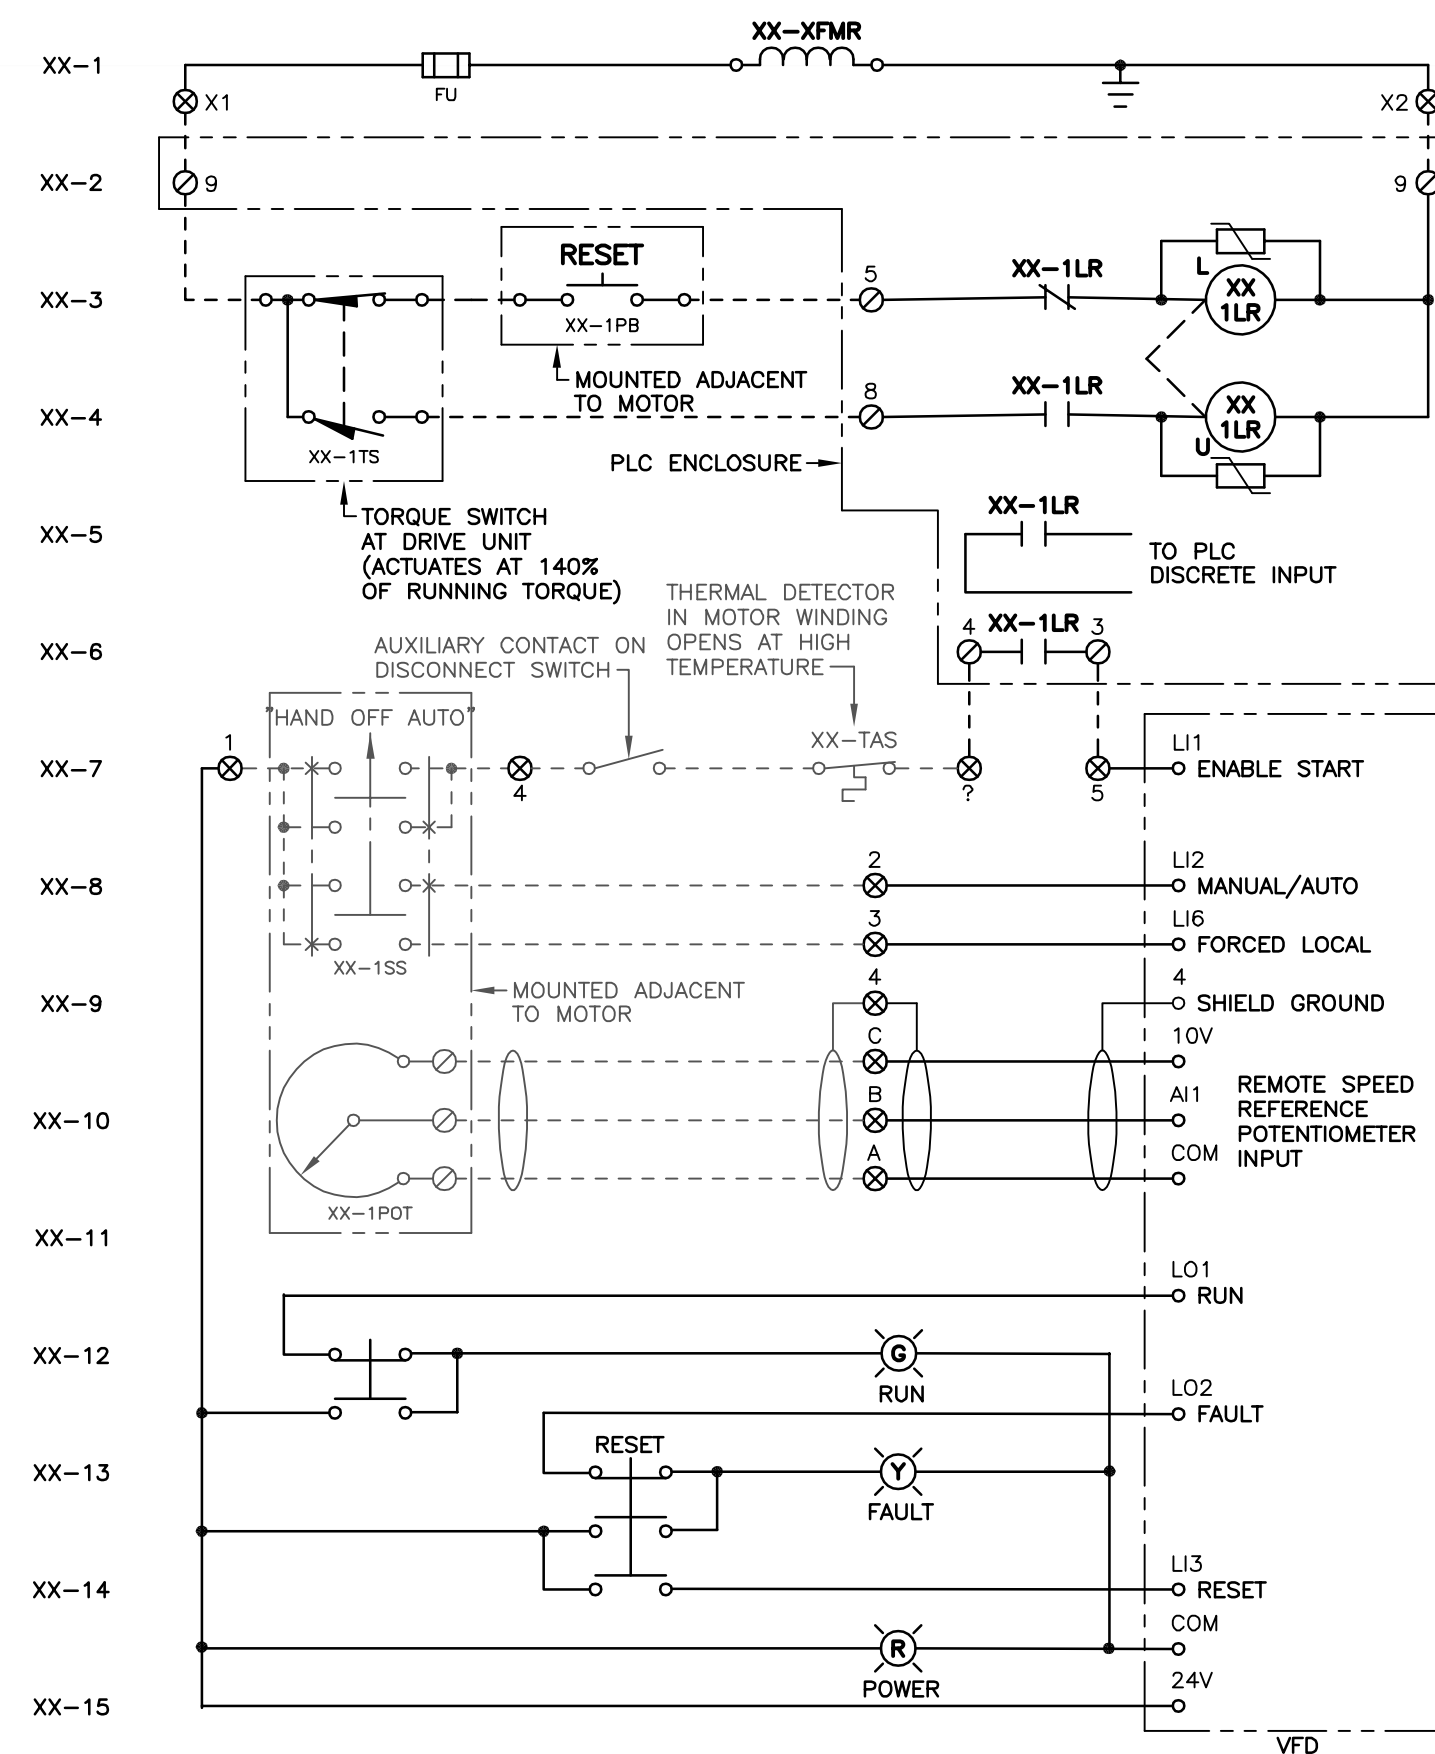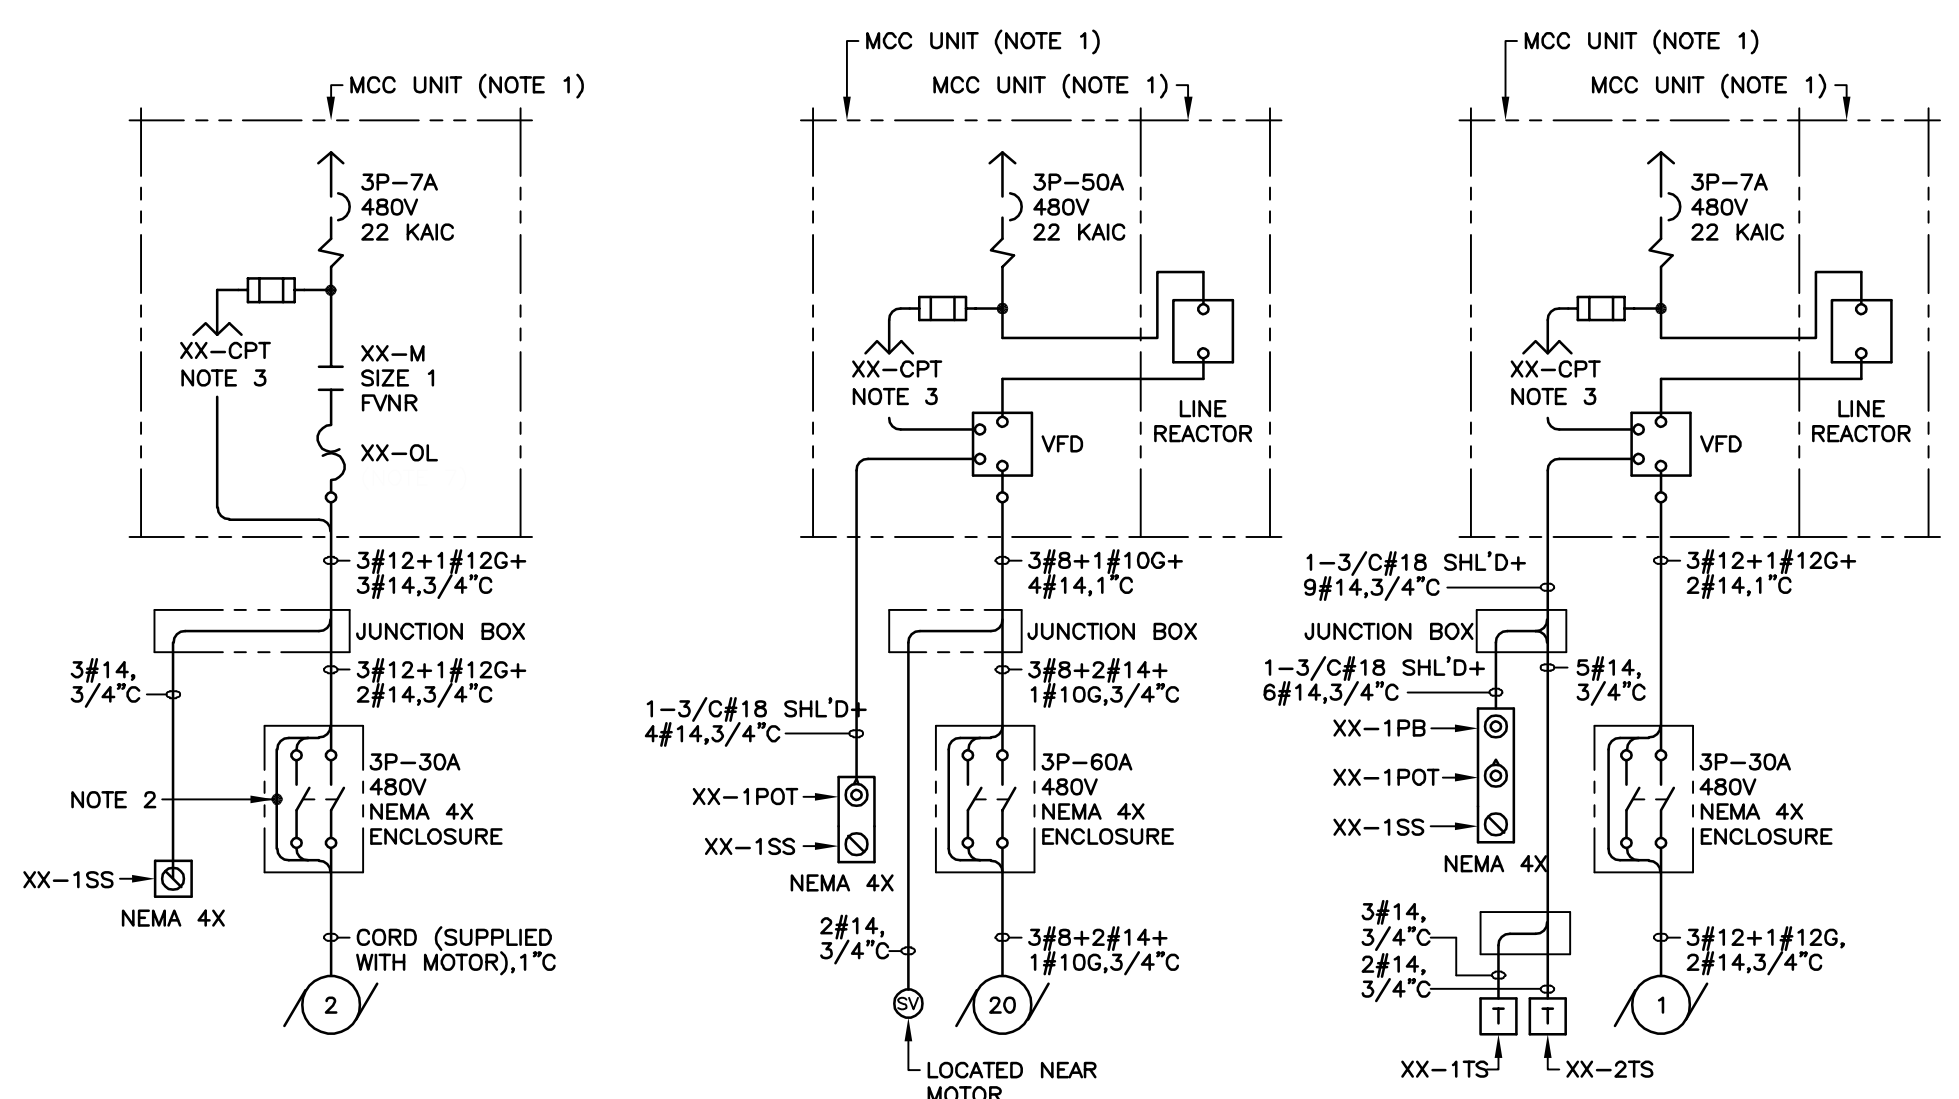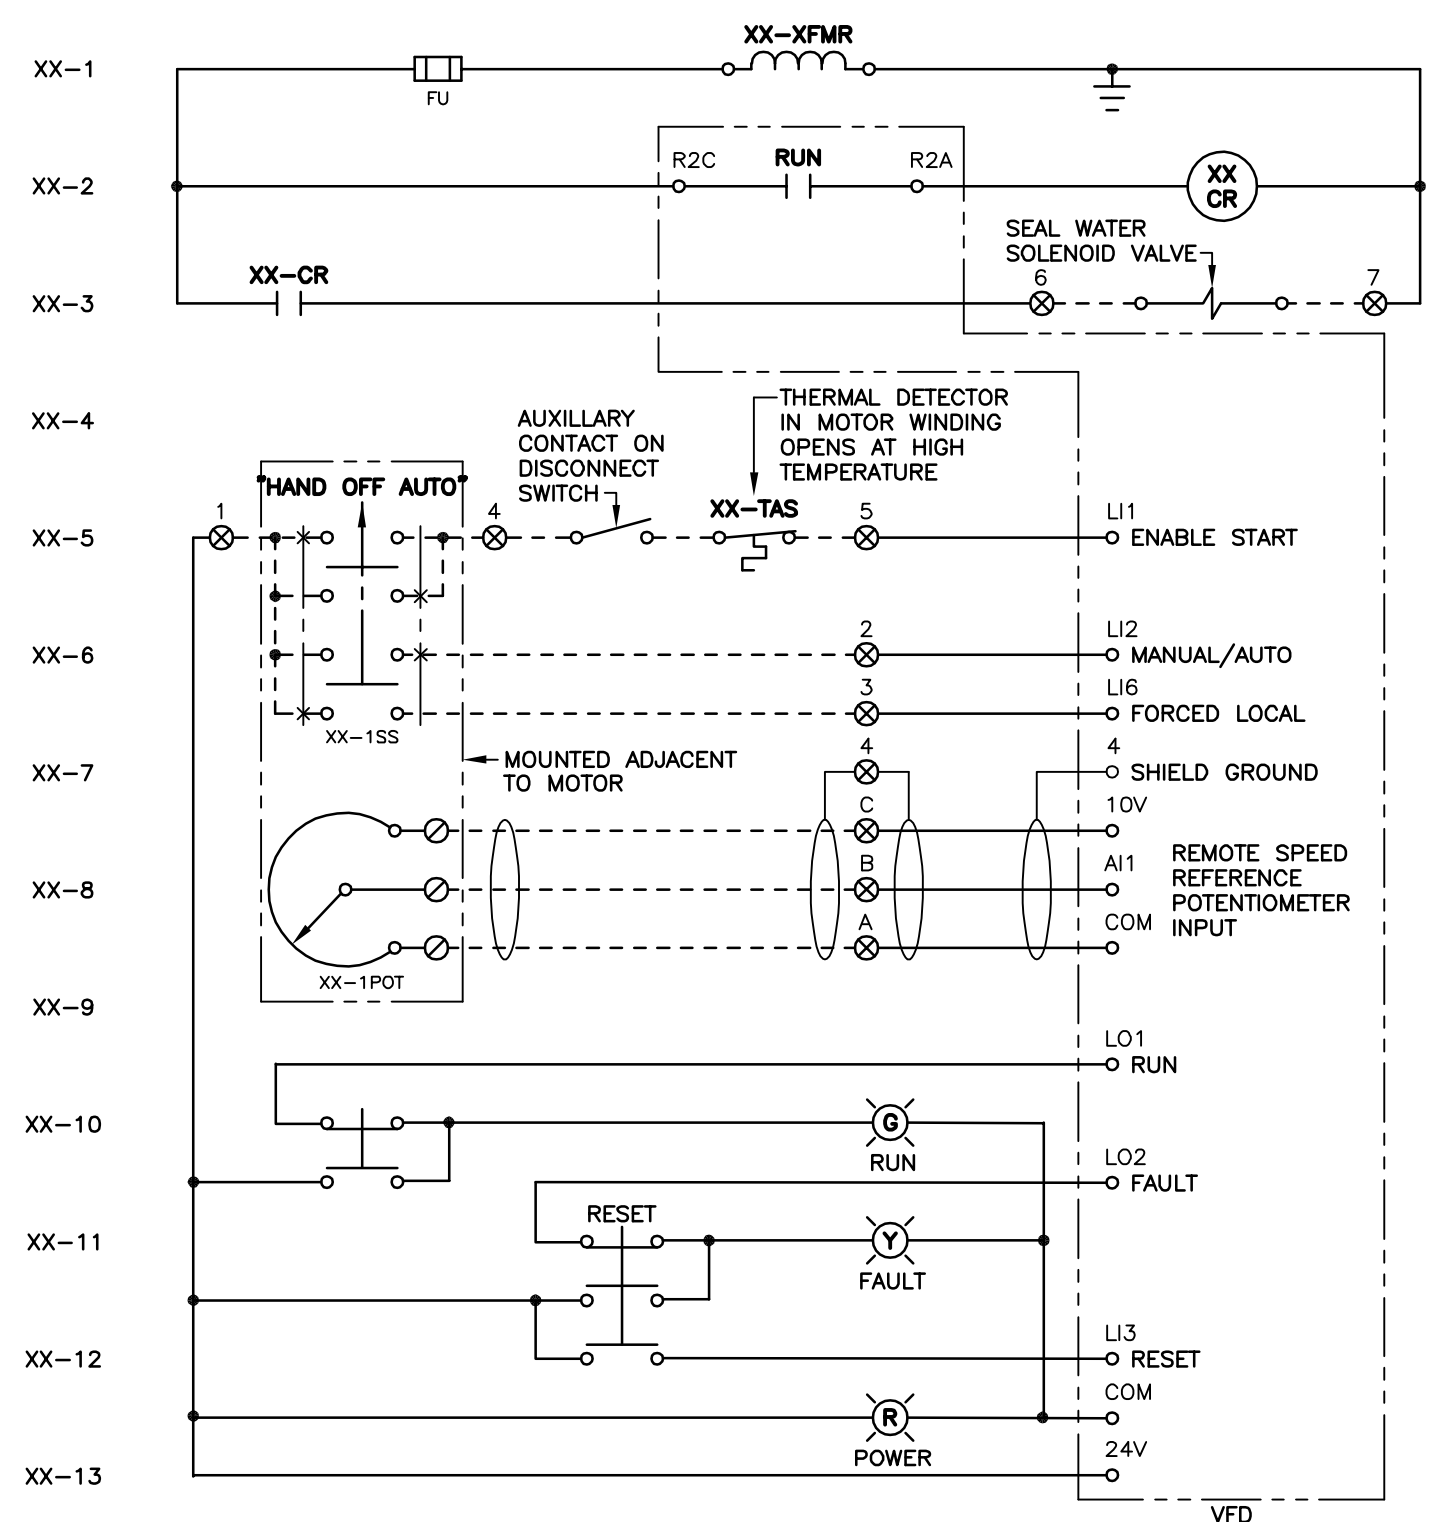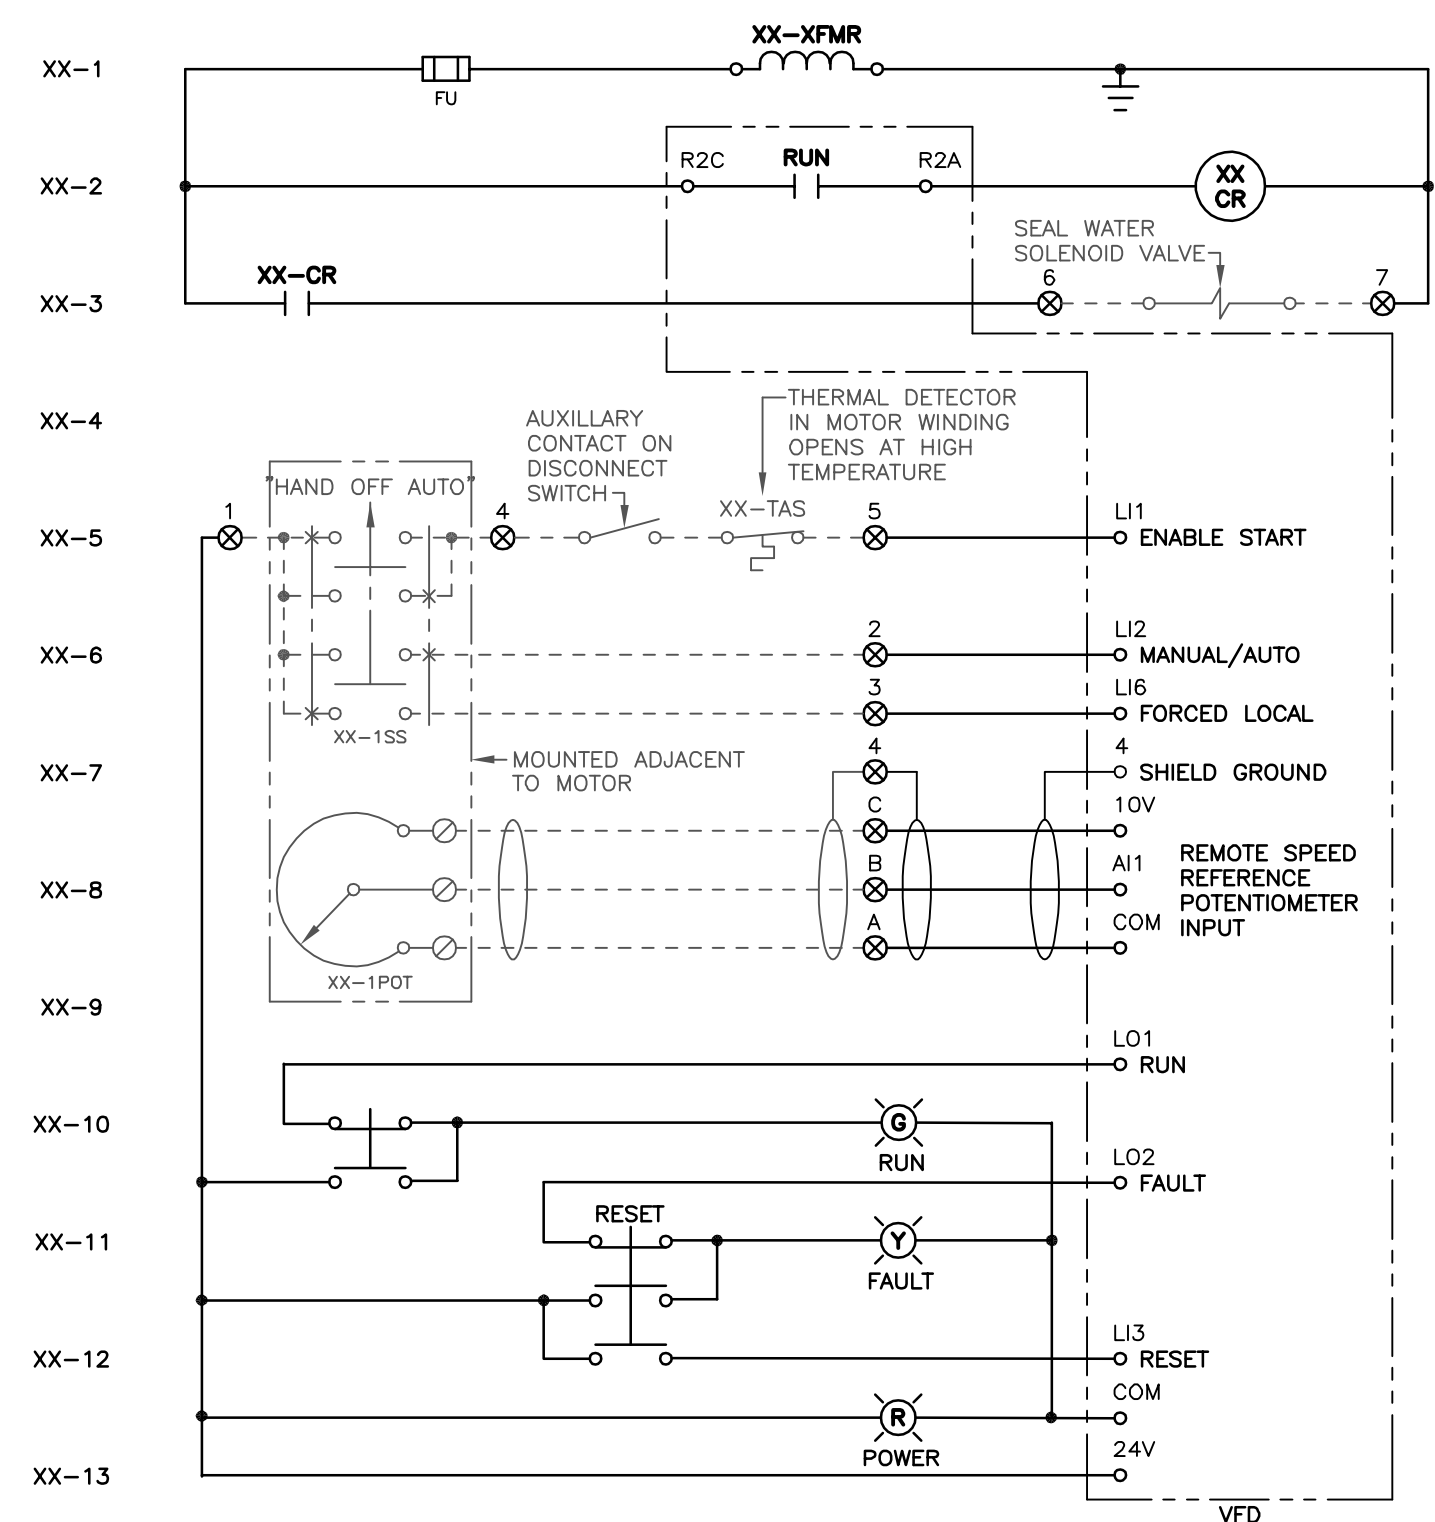


- NOTES:**
- SEE DRAWING E-1 FOR GENERAL NOTES AND FOR GENERAL PLAN NOTES.
1. PROVIDE NEW MCC UNIT IN EXISTING MCC. SEE DRAWING E-2 FOR ADDITIONAL INFORMATION.
 2. PROVIDE NEW VFD UNIT IN EXISTING MCC SPACE. RECONNECT EXISTING FIELD DEVICES AS SHOWN.
 3. PROVIDE NEW VFD UNIT IN EXISTING MCC.
 4. PROVIDE NEW STARTER UNIT IN EXISTING MCC

Z:\LUBS\G&OS\21462\Cad\21462_E4.DWG, 1/3/2022 2:43 PM, DAVE A. BOWMAN



PRELIMINARY
NOT FOR
CONSTRUCTION

No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: DAB		
CHECKED BY: DAB		
DRAWN BY: DEK		
DESIGNER: DAB		
G & O JOB NO.: 21462		
FILE: 21462_E5.DWG		




ELECTRICAL


APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

PLC CONTROL
SYSTEM
MODIFICATIONS


DRAWING: **E-5** OF: **7**

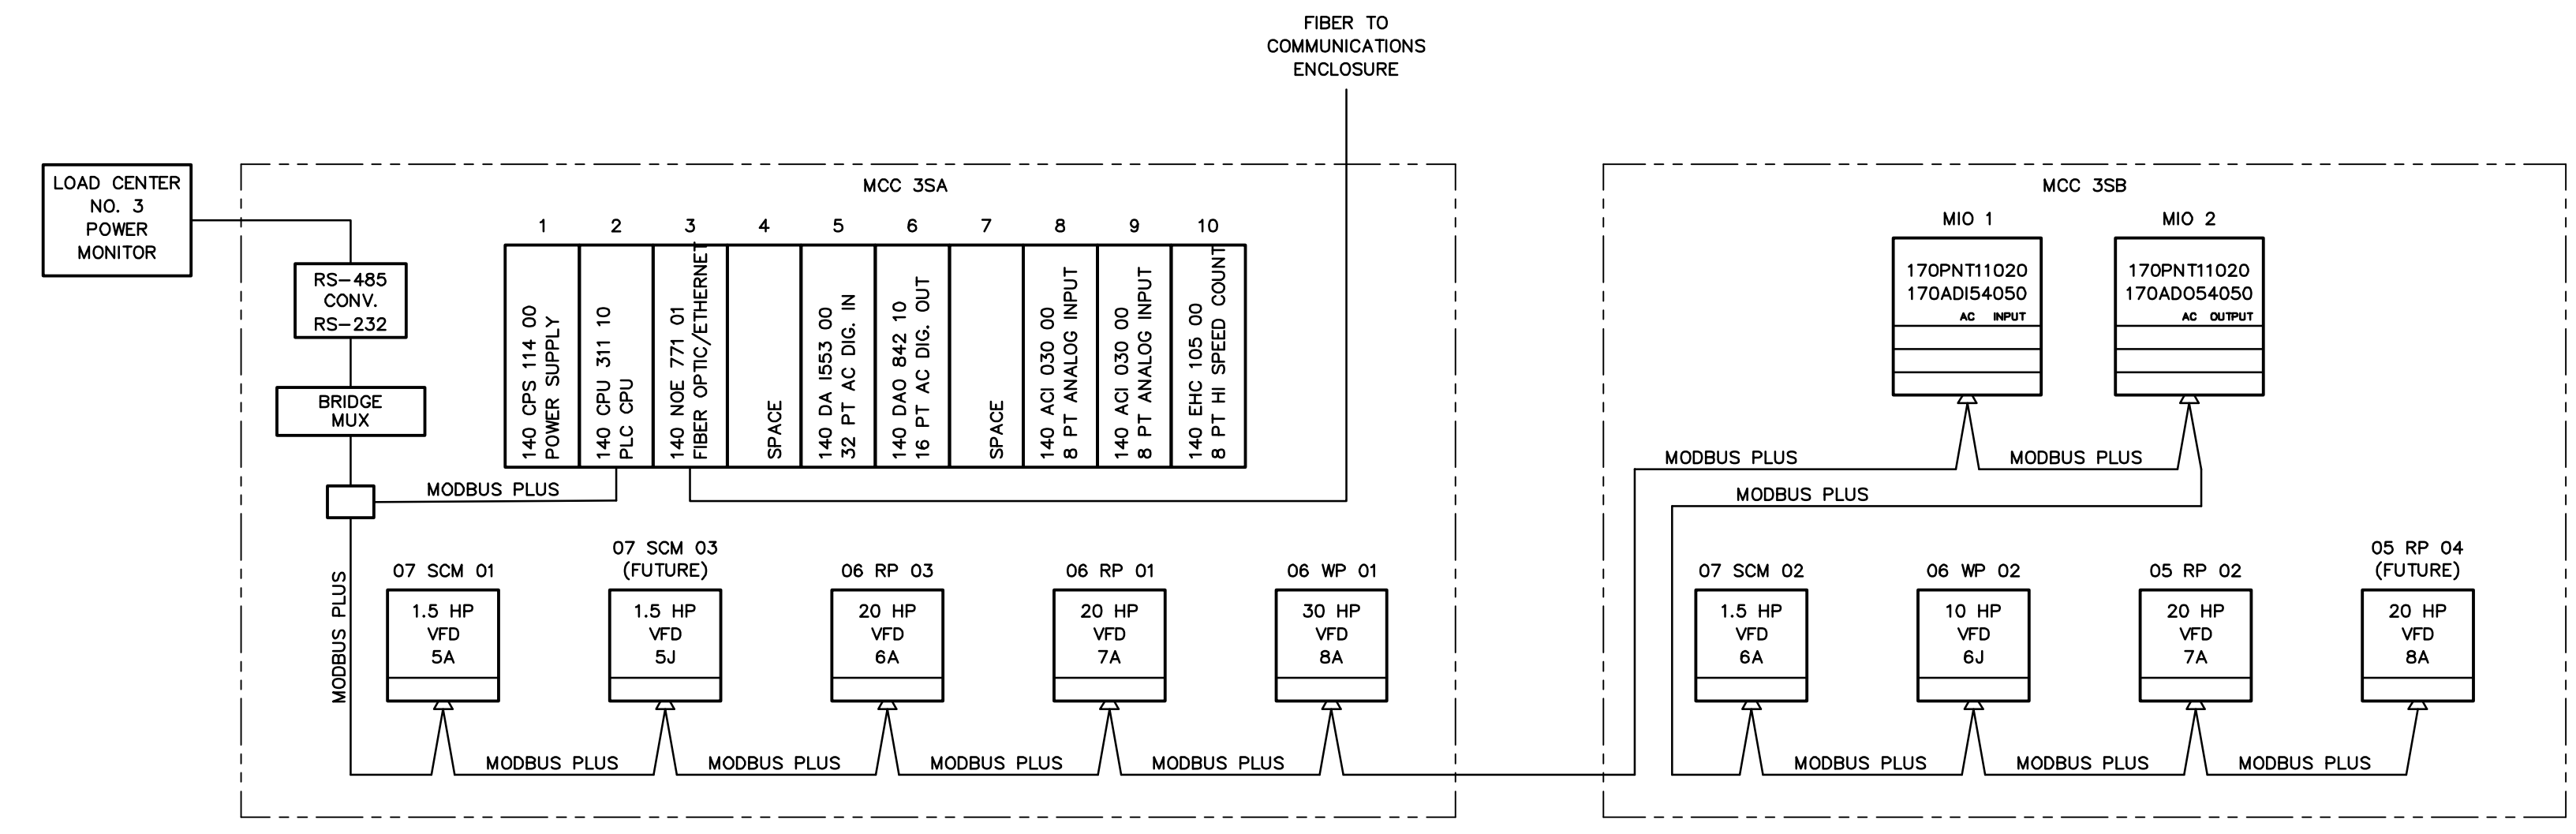

EXISTING COMMUNICATION DIAGRAM

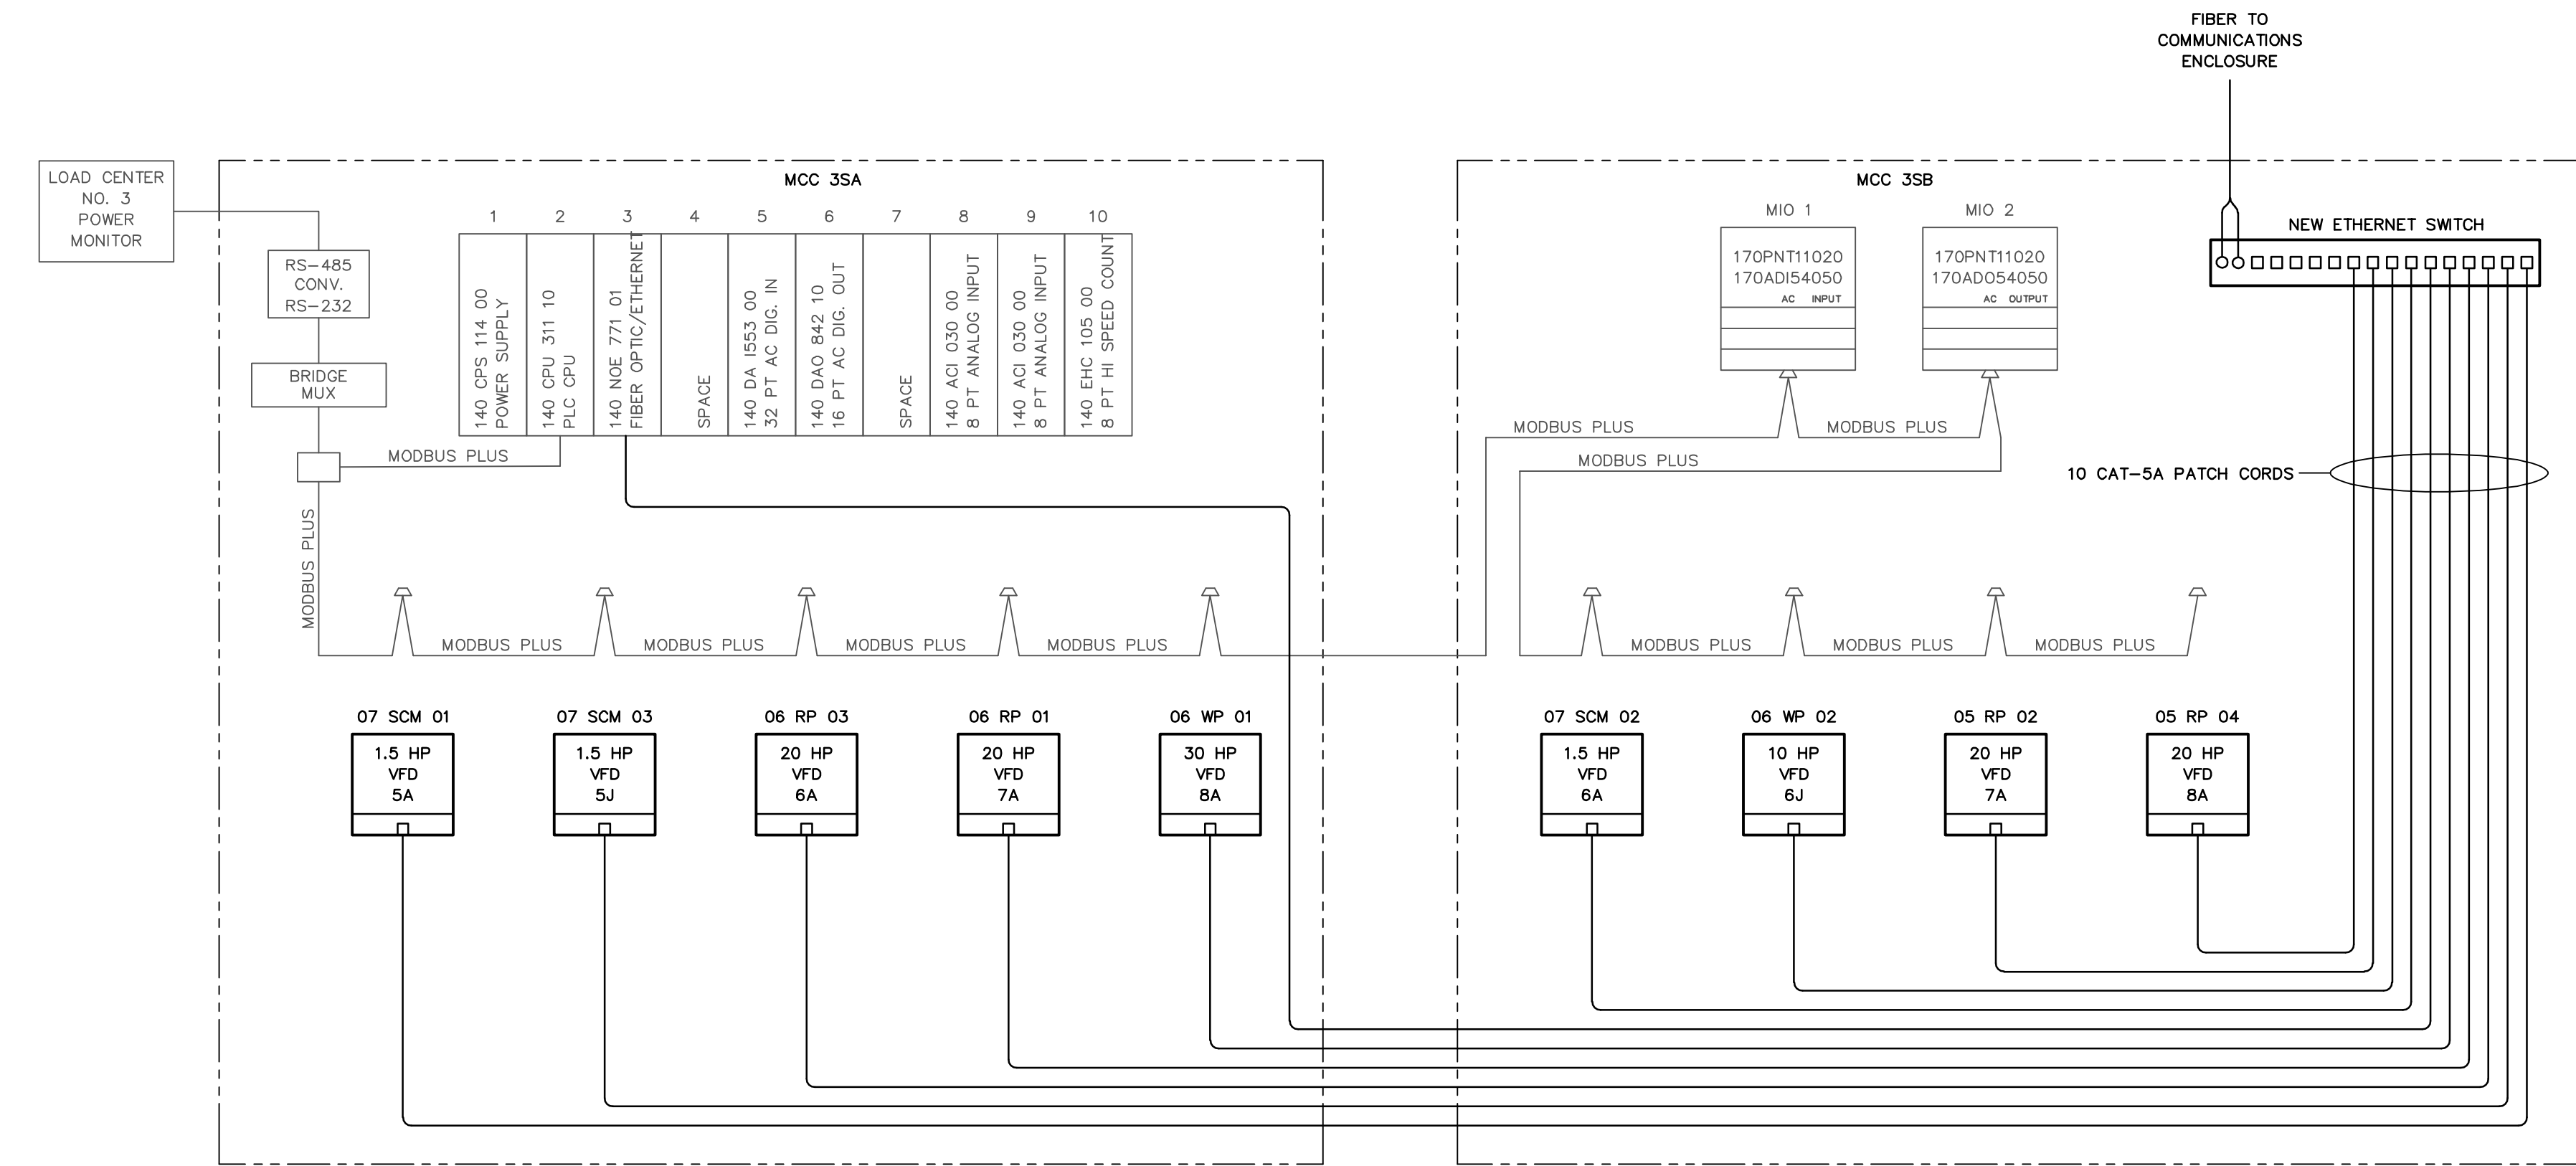


MODIFIED COMMUNICATION DIAGRAM



PRELIMINARY
NOT FOR
CONSTRUCTION

No.	DATE	REVISION

ISSUED FOR:	90% DESIGN REVIEW
ISSUE DATE:	DECEMBER 2021
APPROVED BY:	DAB
CHECKED BY:	DAB
DRAWN BY:	DEK
DESIGNER:	DAB
G & O JOB NO.:	21462
FILE:	21462_E6.DWG



ELECTRICAL

APPROVED


BY: _____
CITY ENGINEER
CITY OF PUYALLUP

APPROVED
DATE: _____
EXPIRATION
DATE: _____


NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.

The City will not be responsible for errors and/or omissions on these plans. Field conditions may dictate changes to these plans as determined by the City Engineer.


ELECTRICAL DETAILS

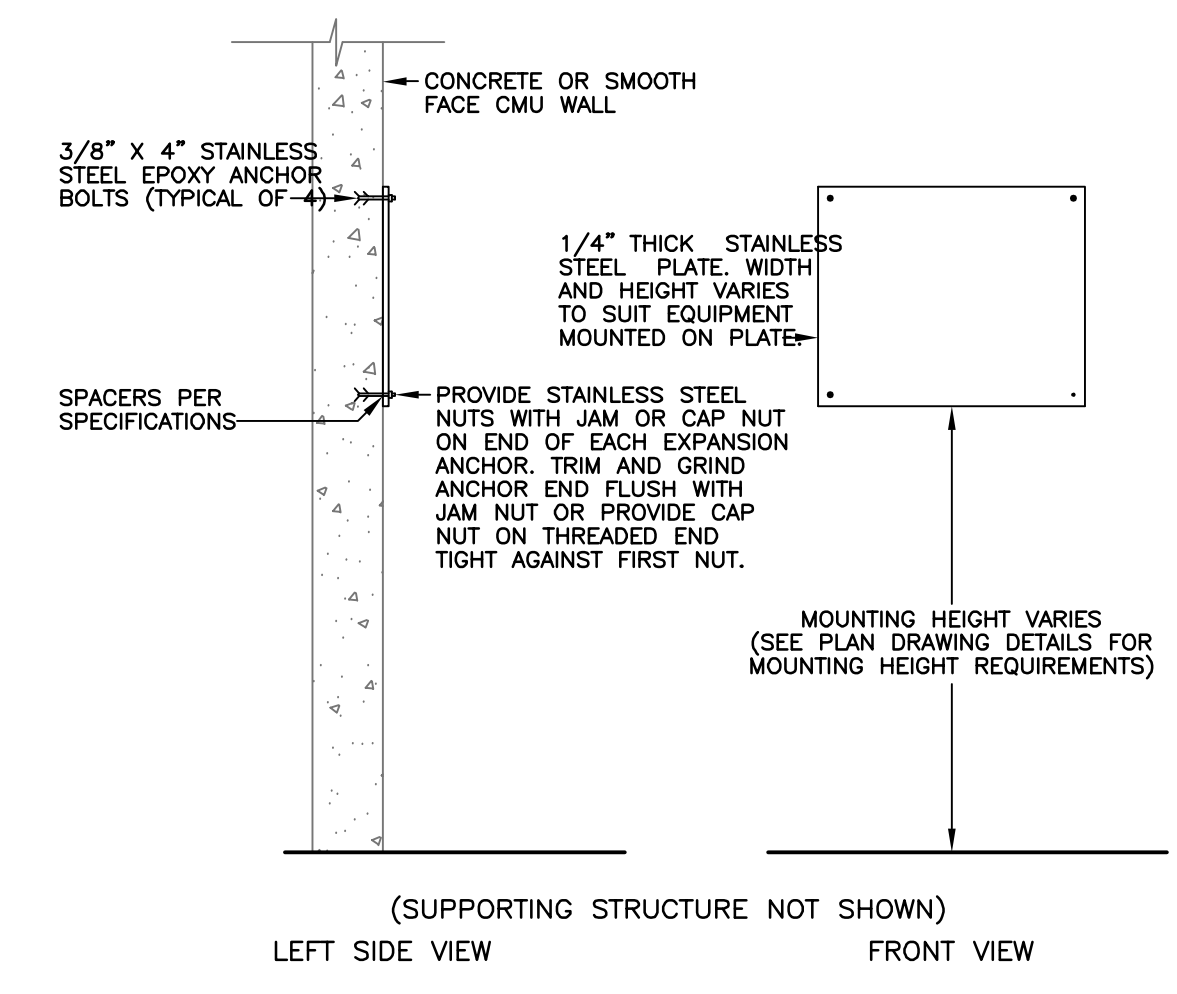


DETAIL 3/E-5
MOUNTING ON CONCRETE
OR SMOOTH FACE CMU WALL
SCALE: NONE

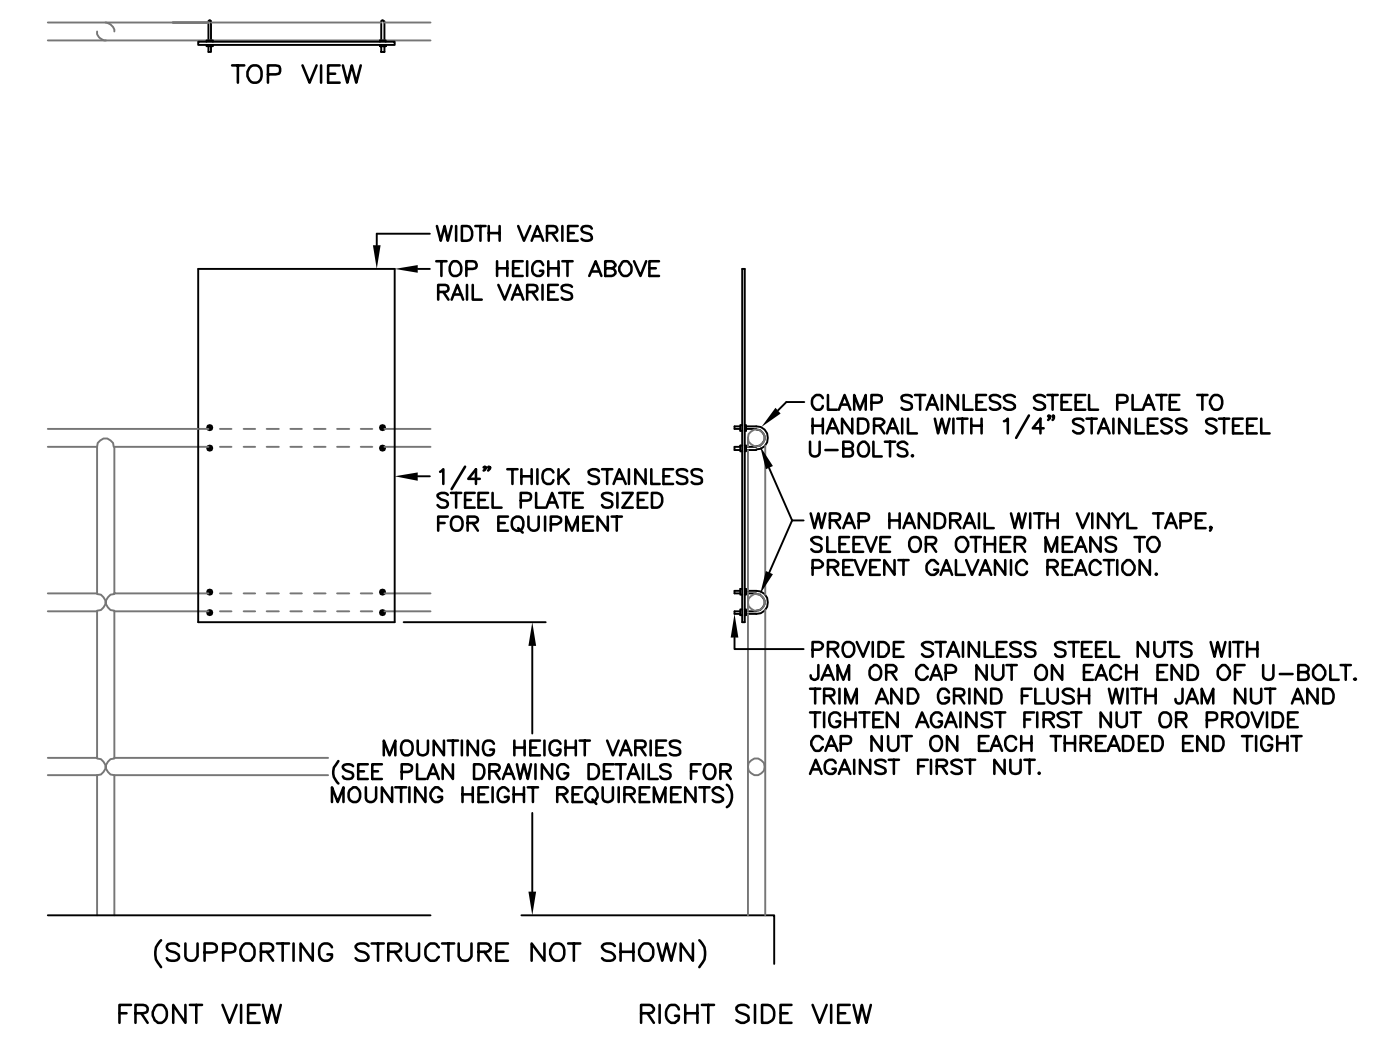

DETAIL 2/E-5
MOUNTING ON RAILING
SCALE: NONE

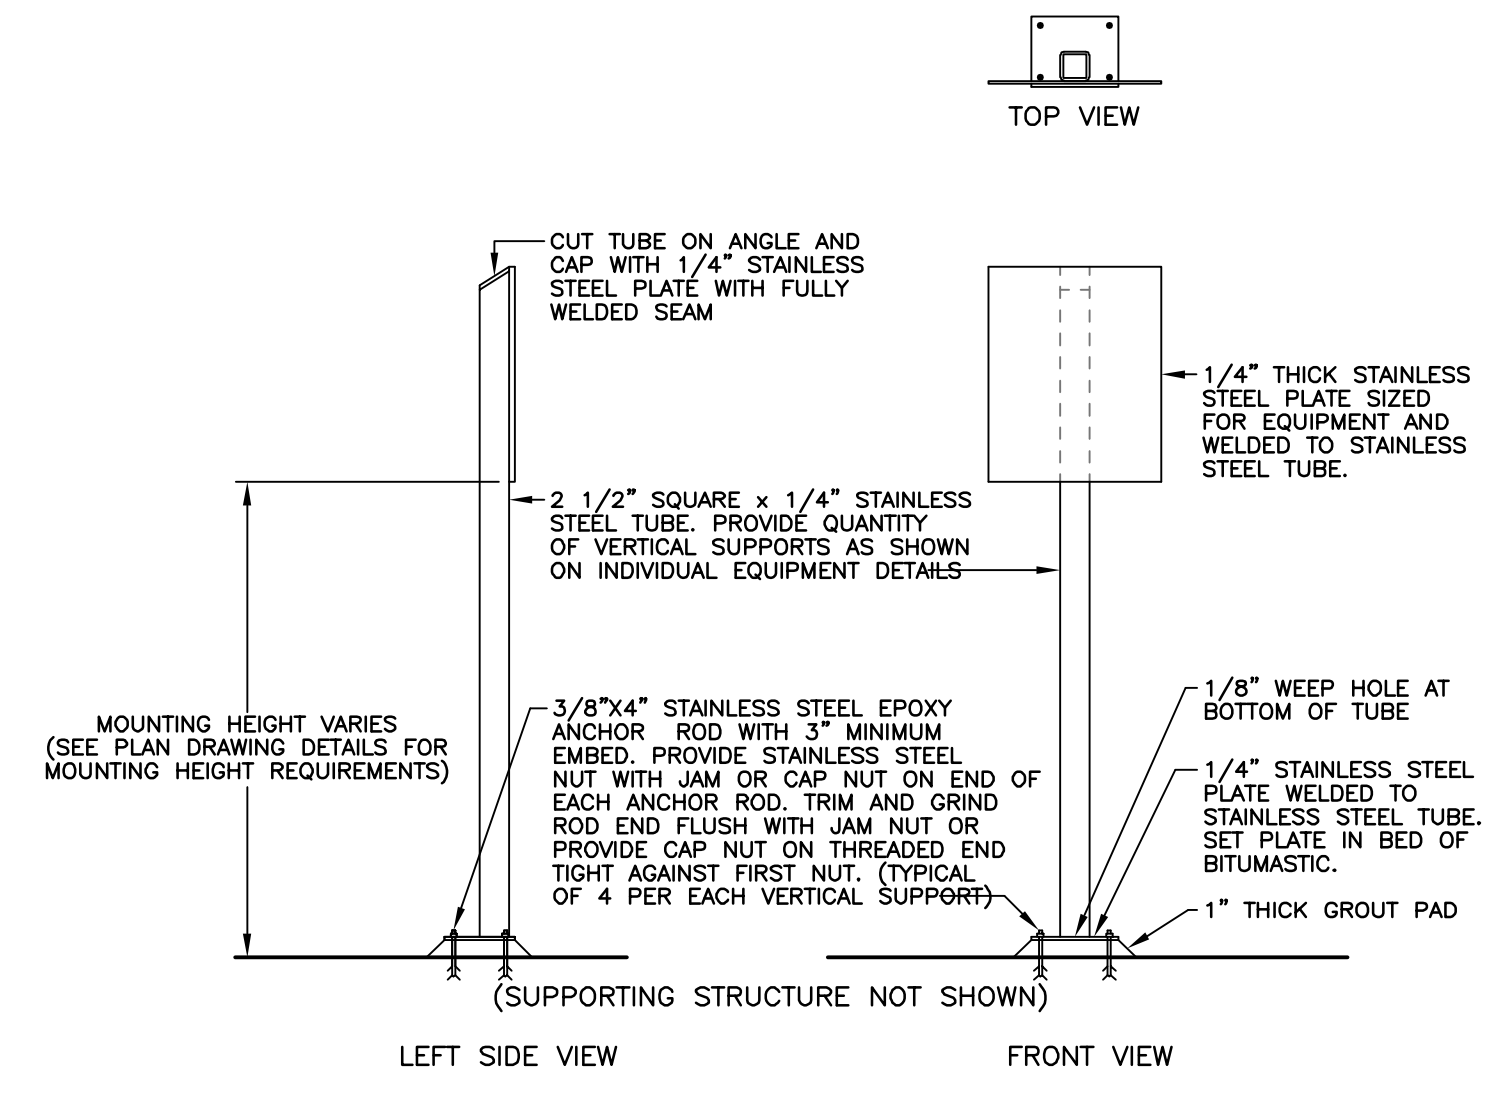


DETAIL 1/E-5
MOUNTING ON STANCHION
SCALE: NONE

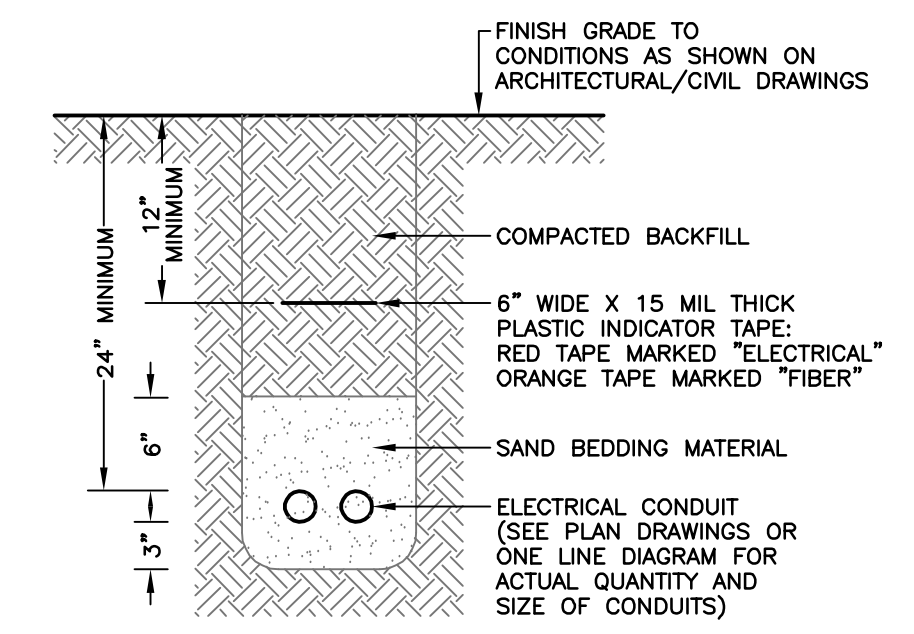


NOTE: CONDUITS ARE SHOWN DIAGRAMMATICALLY. SEE PLAN DRAWINGS FOR ACTUAL CONDUIT QUANTITIES, DEPTH, SIZES AND ARRANGEMENTS.

DETAIL 6/E-5
TRENCHING FOR ELECTRICAL CIRCUITS
SECONDARY POWER OR SIGNAL CIRCUITS
SCALE: NONE

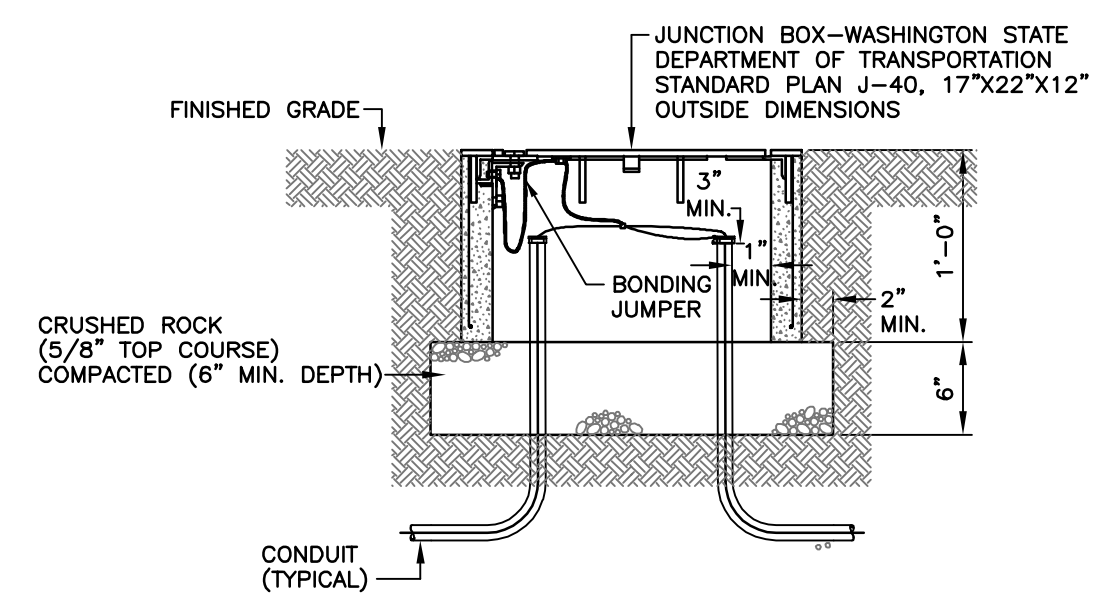


NOTE: CONDUITS ARE SHOWN DIAGRAMMATICALLY. SEE PLAN DRAWINGS FOR ACTUAL CONDUIT QUANTITIES, DEPTH, SIZES AND ARRANGEMENTS.

DETAIL 5/E-5
TYPE 1L JUNCTION BOX
SCALE: NONE

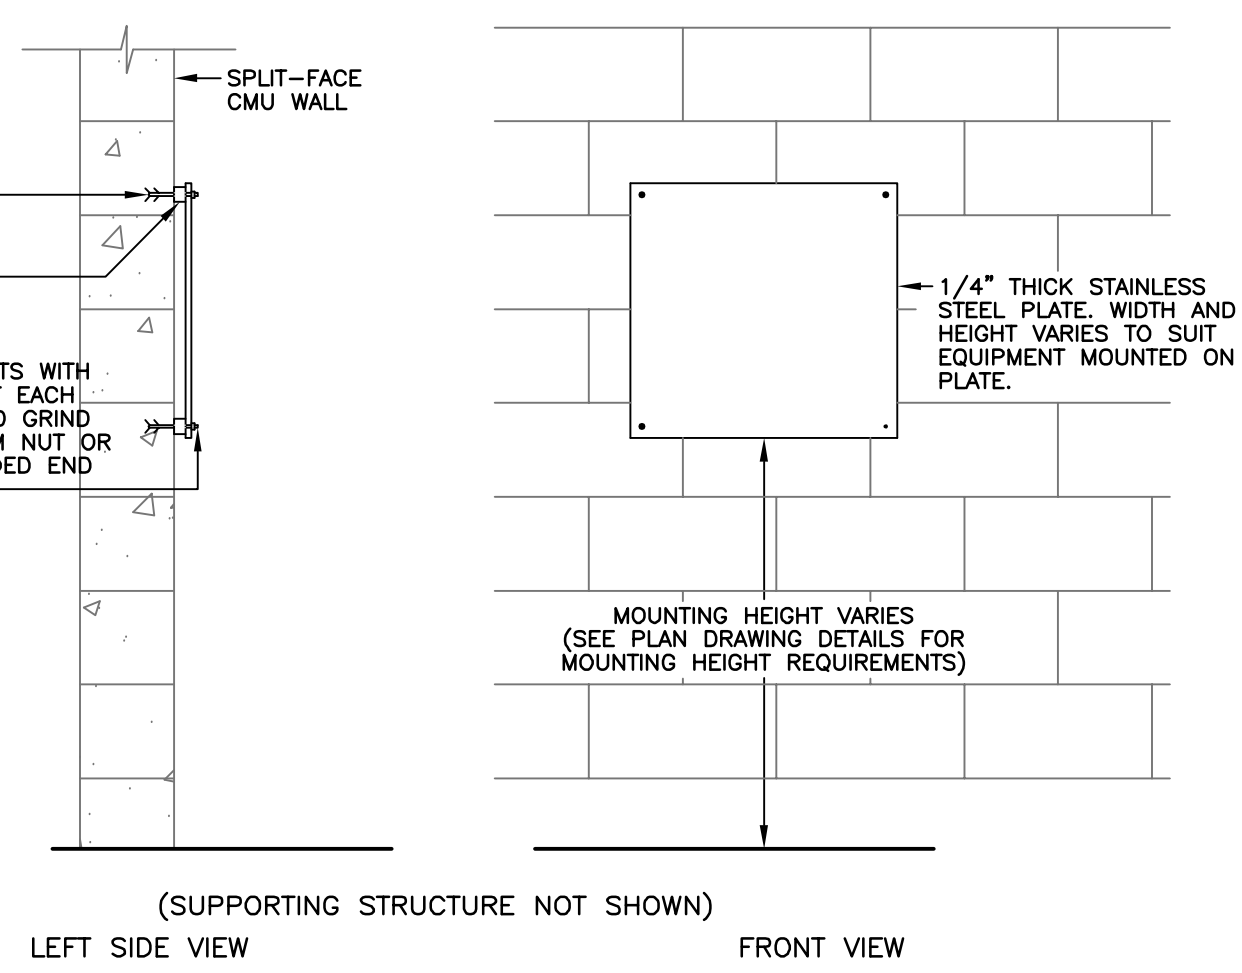

DETAIL 4/E-5
MOUNTING ON SPLIT FACE CMU WALL
SCALE: NONE


Z:\JOB\G&O\21462\Cad\21462_E6.DWG, 1/31/2022 2:46 PM, DAVE A. BOWMAN



**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION

ISSUED FOR:	90% DESIGN REVIEW
ISSUE DATE:	DECEMBER 2021
APPROVED BY:	DAB
CHECKED BY:	DAB
DRAWN BY:	DEK
DESIGNER:	DAB
G & O JOB NO.:	21462
FILE:	21462_E7.DWG




ELECTRICAL


APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

**SCUM PUMP CONTROL
PANEL NO.2 DETAILS**


DRAWING: **E-7** OF: **7**

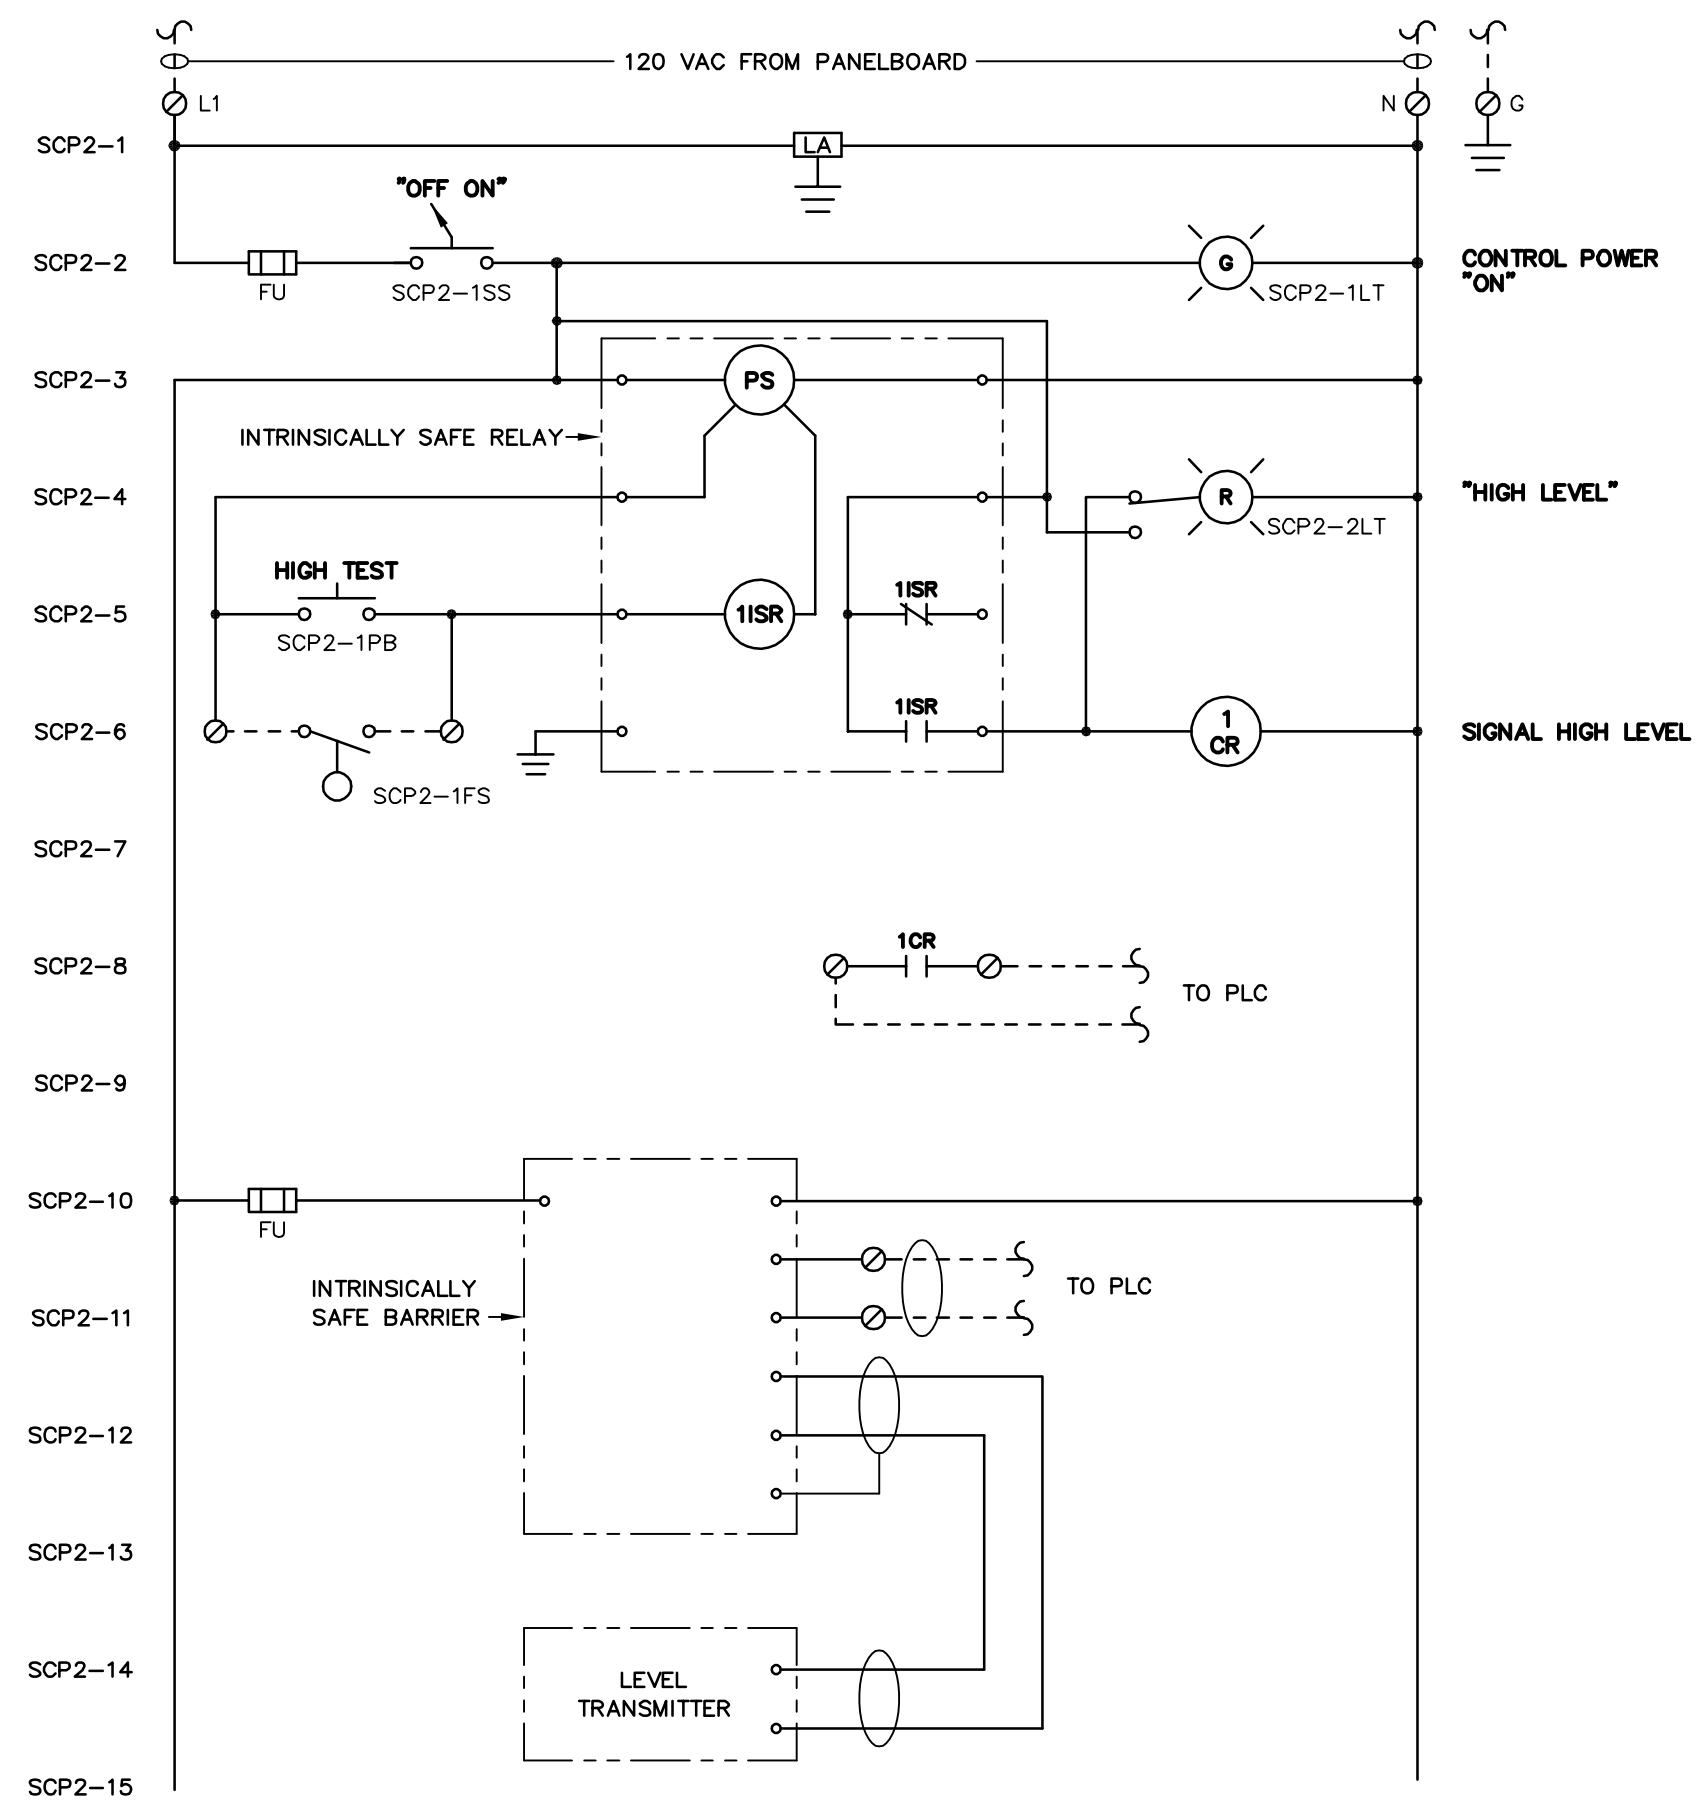


**ELEMENTARY WIRING DIAGRAM
SCUM PUMP NO.2 CONTROL PANEL**

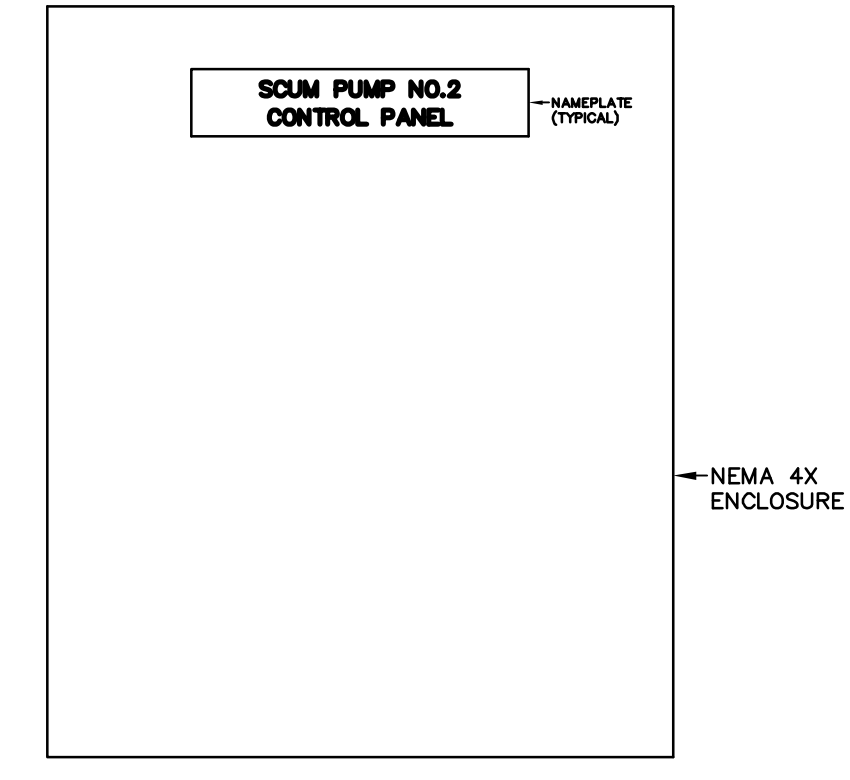

**EXTERIOR ELEVATION
SCUM PUMP CONTROL PANEL NO.2**
SCALE: 1/2"=1'

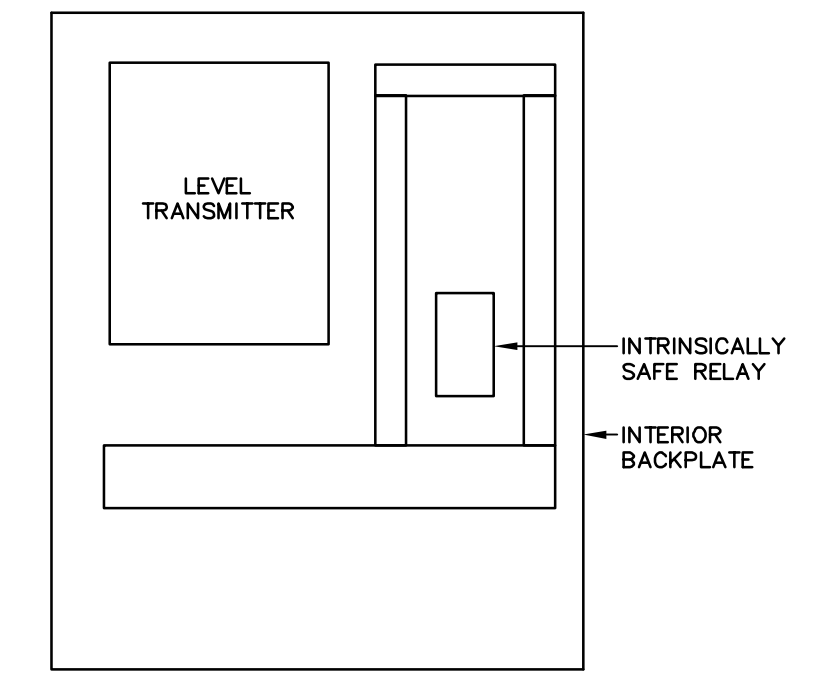


**INTERIOR ELEVATION
SCUM PUMP CONTROL PANEL NO.2**
SCALE: 1/2"=1'



**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: DAB		
CHECKED BY: BBB		
DRAWN BY: DEK		
DESIGNER: DAB		
G & O JOB NO.: 21462		
FILE: 21462_E6-1.DWG		



**ELECTRICAL
AREA 6**


**DEMO AND MODIFIED
RAS/WAS BUILDING
MAIN LEVEL**

DRAWING: **E6-1** OF: **2**


NOTES:

SEE DRAWING E-1 FOR GENERAL NOTES AND FOR GENERAL PLAN NOTES.

- SEE MCC ELEVATIONS AND ONE LINE DIAGRAMS DRAWINGS E-2, E-3 & E-4 FOR ADDITIONAL INFORMATION.
- SEE DRAWING E-5 FOR ADDITIONAL INFORMATION.
- PROVIDE CONDUCTORS PER MANUFACTURER'S REQUIREMENTS IN 3/4"C.
- DEMOLISH EXISTING HVAC EQUIPMENT CIRCUIT BACK TO EXISTING PANELBOARD. CONDUIT MAY BE REUSED FOR NEW HVAC EQUIPMENT AT CONTRACTOR'S OPTION.
- PROVIDE LED LIGHTING FIXTURE SURFACE MOUNTED TO WALL IN STAIRWELL AT 8 FEET ABOVE PLATFORM LANDING. LIGHTING FIXTURE SHALL BE 4 FOOT LONG, ENCLOSED AND CASKITED, ONE PIECE MOLDED FIBERGLASS REINFORCED POLYESTER BODY WITH END ENTRY HUBS, IMPACT RESISTANT POLYCARBONATE DIFFUSER WITH STAINLESS STEEL LATCHES, WET LABEL, AND FIVE YEAR WARRANTY. METALUX MODEL 4VT3-LD5-4-W-UNV-LB40-SSL OR EQUAL.

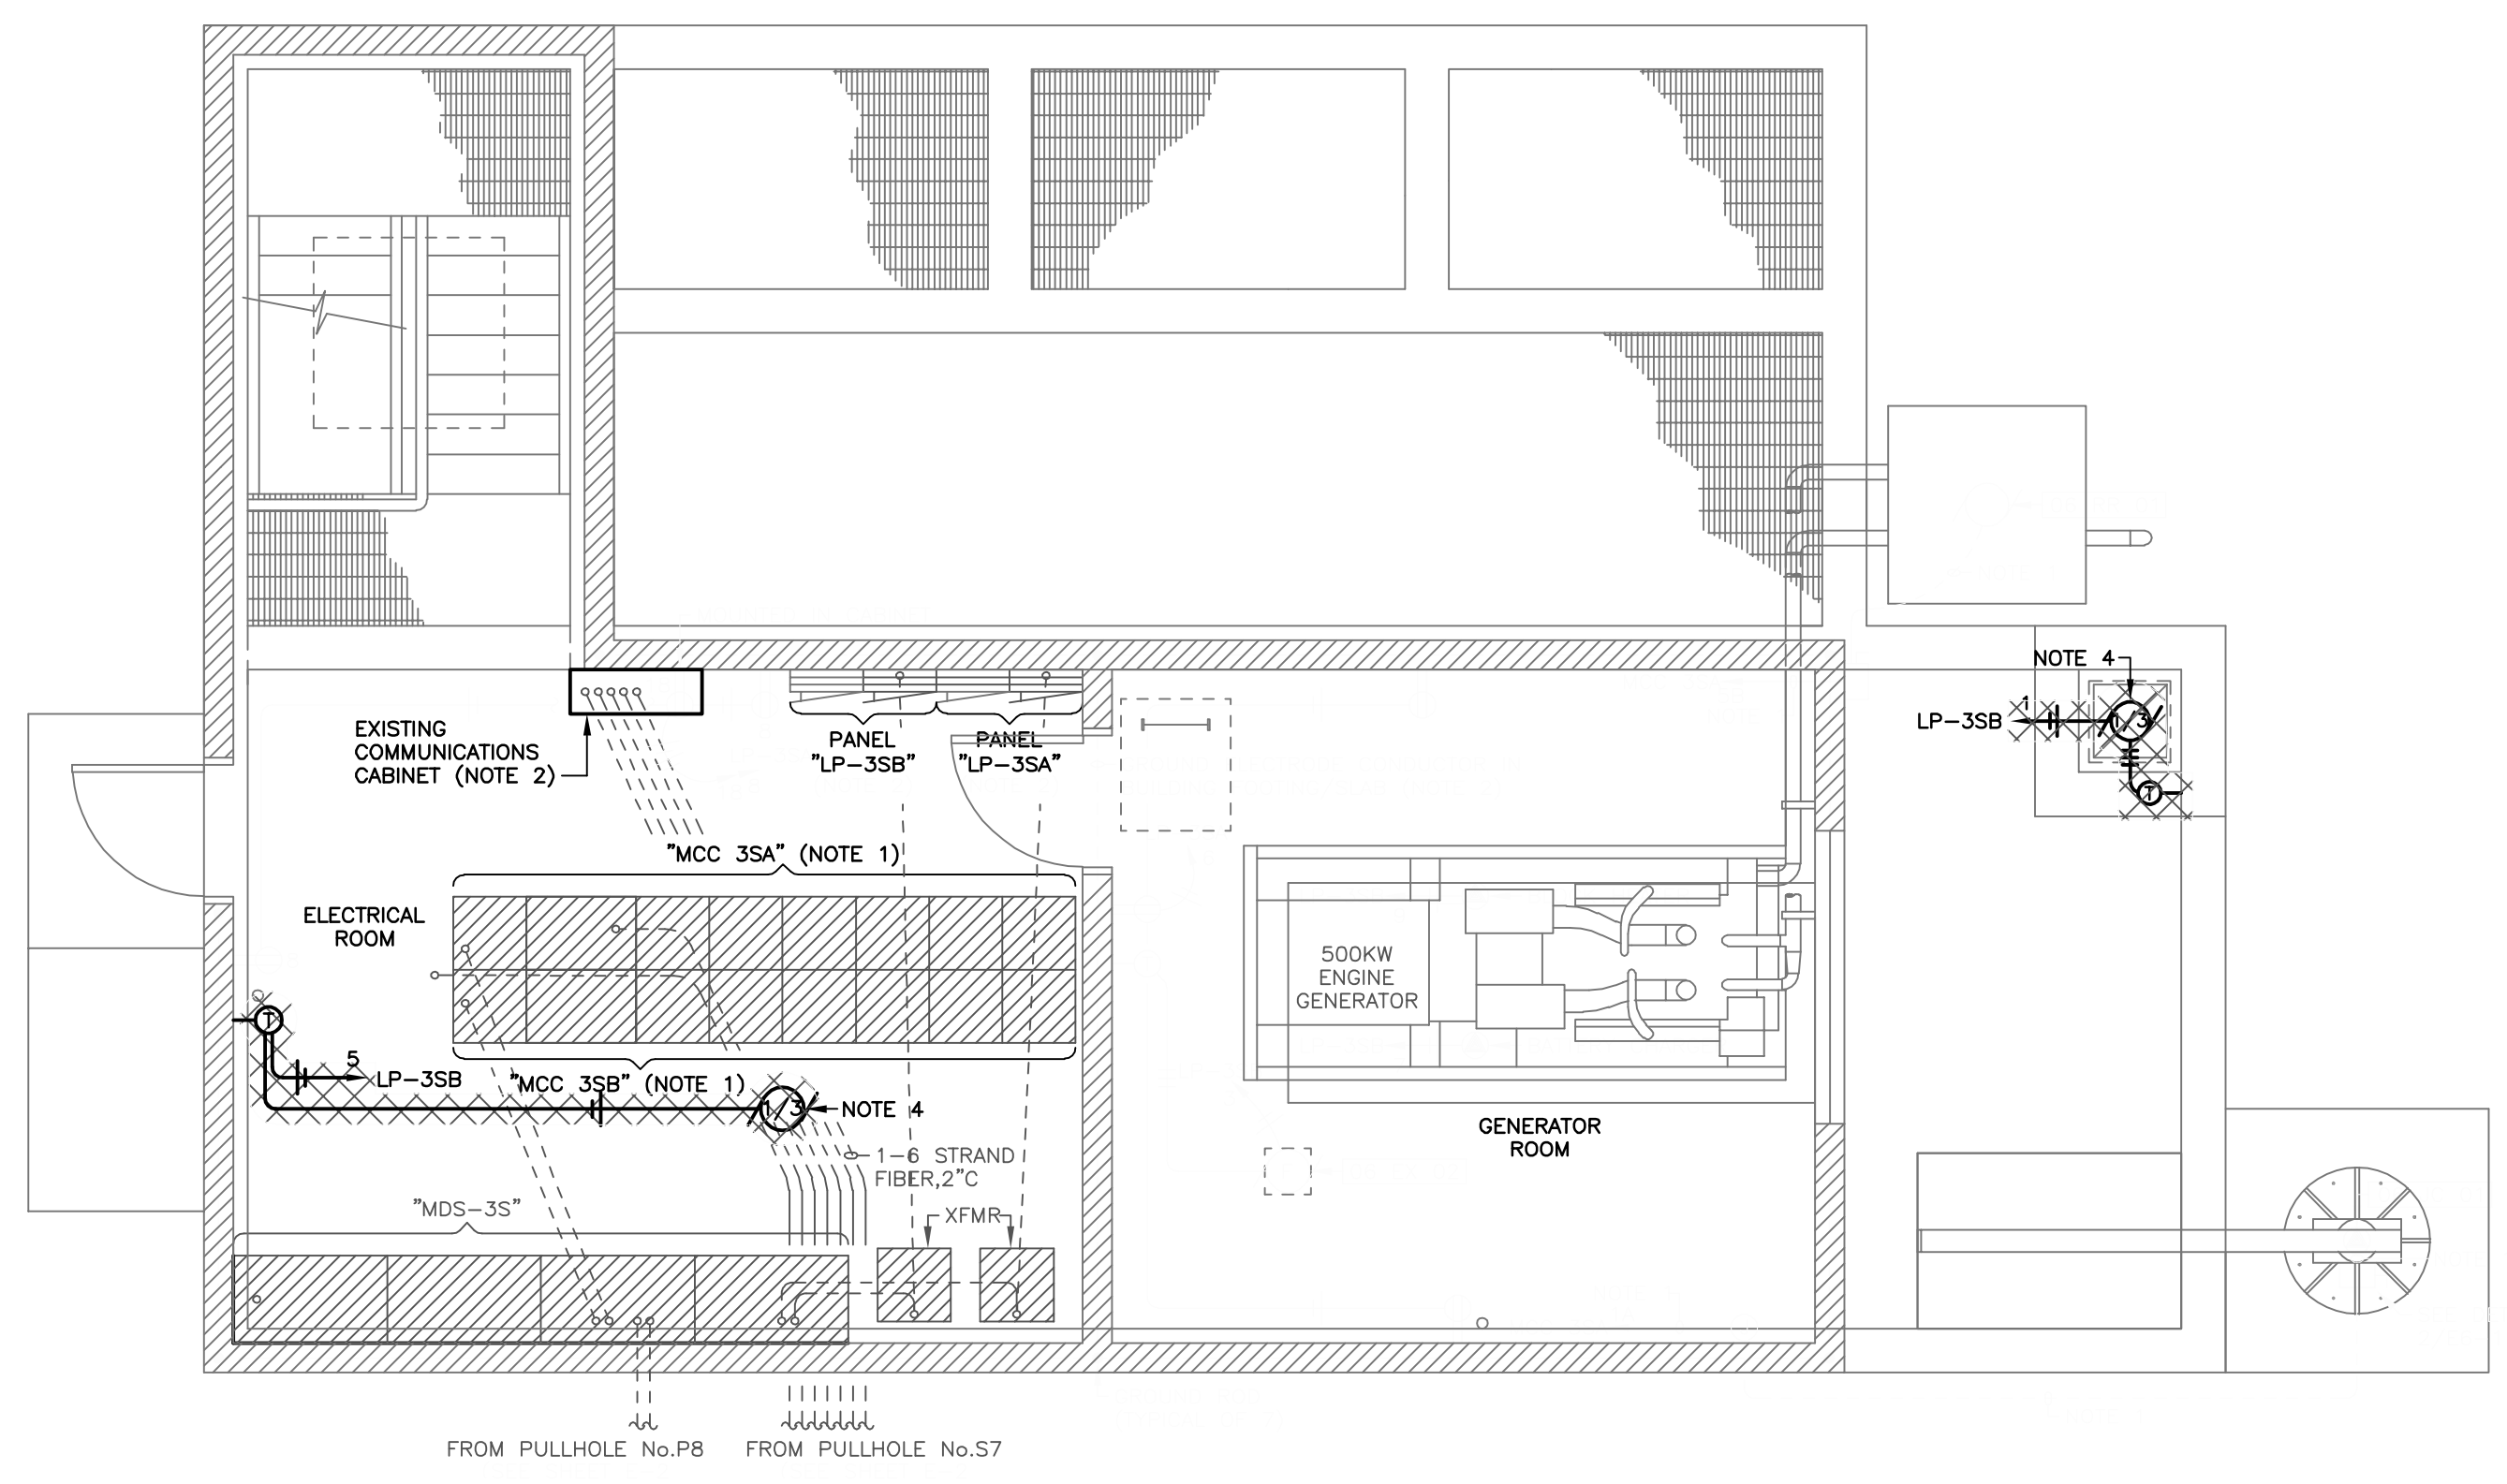

**DEMOLITION ELECTRICAL PLAN
RAS/WAS BUILDING - MAIN LEVEL**
SCALE: 1/4" = 1'-0"

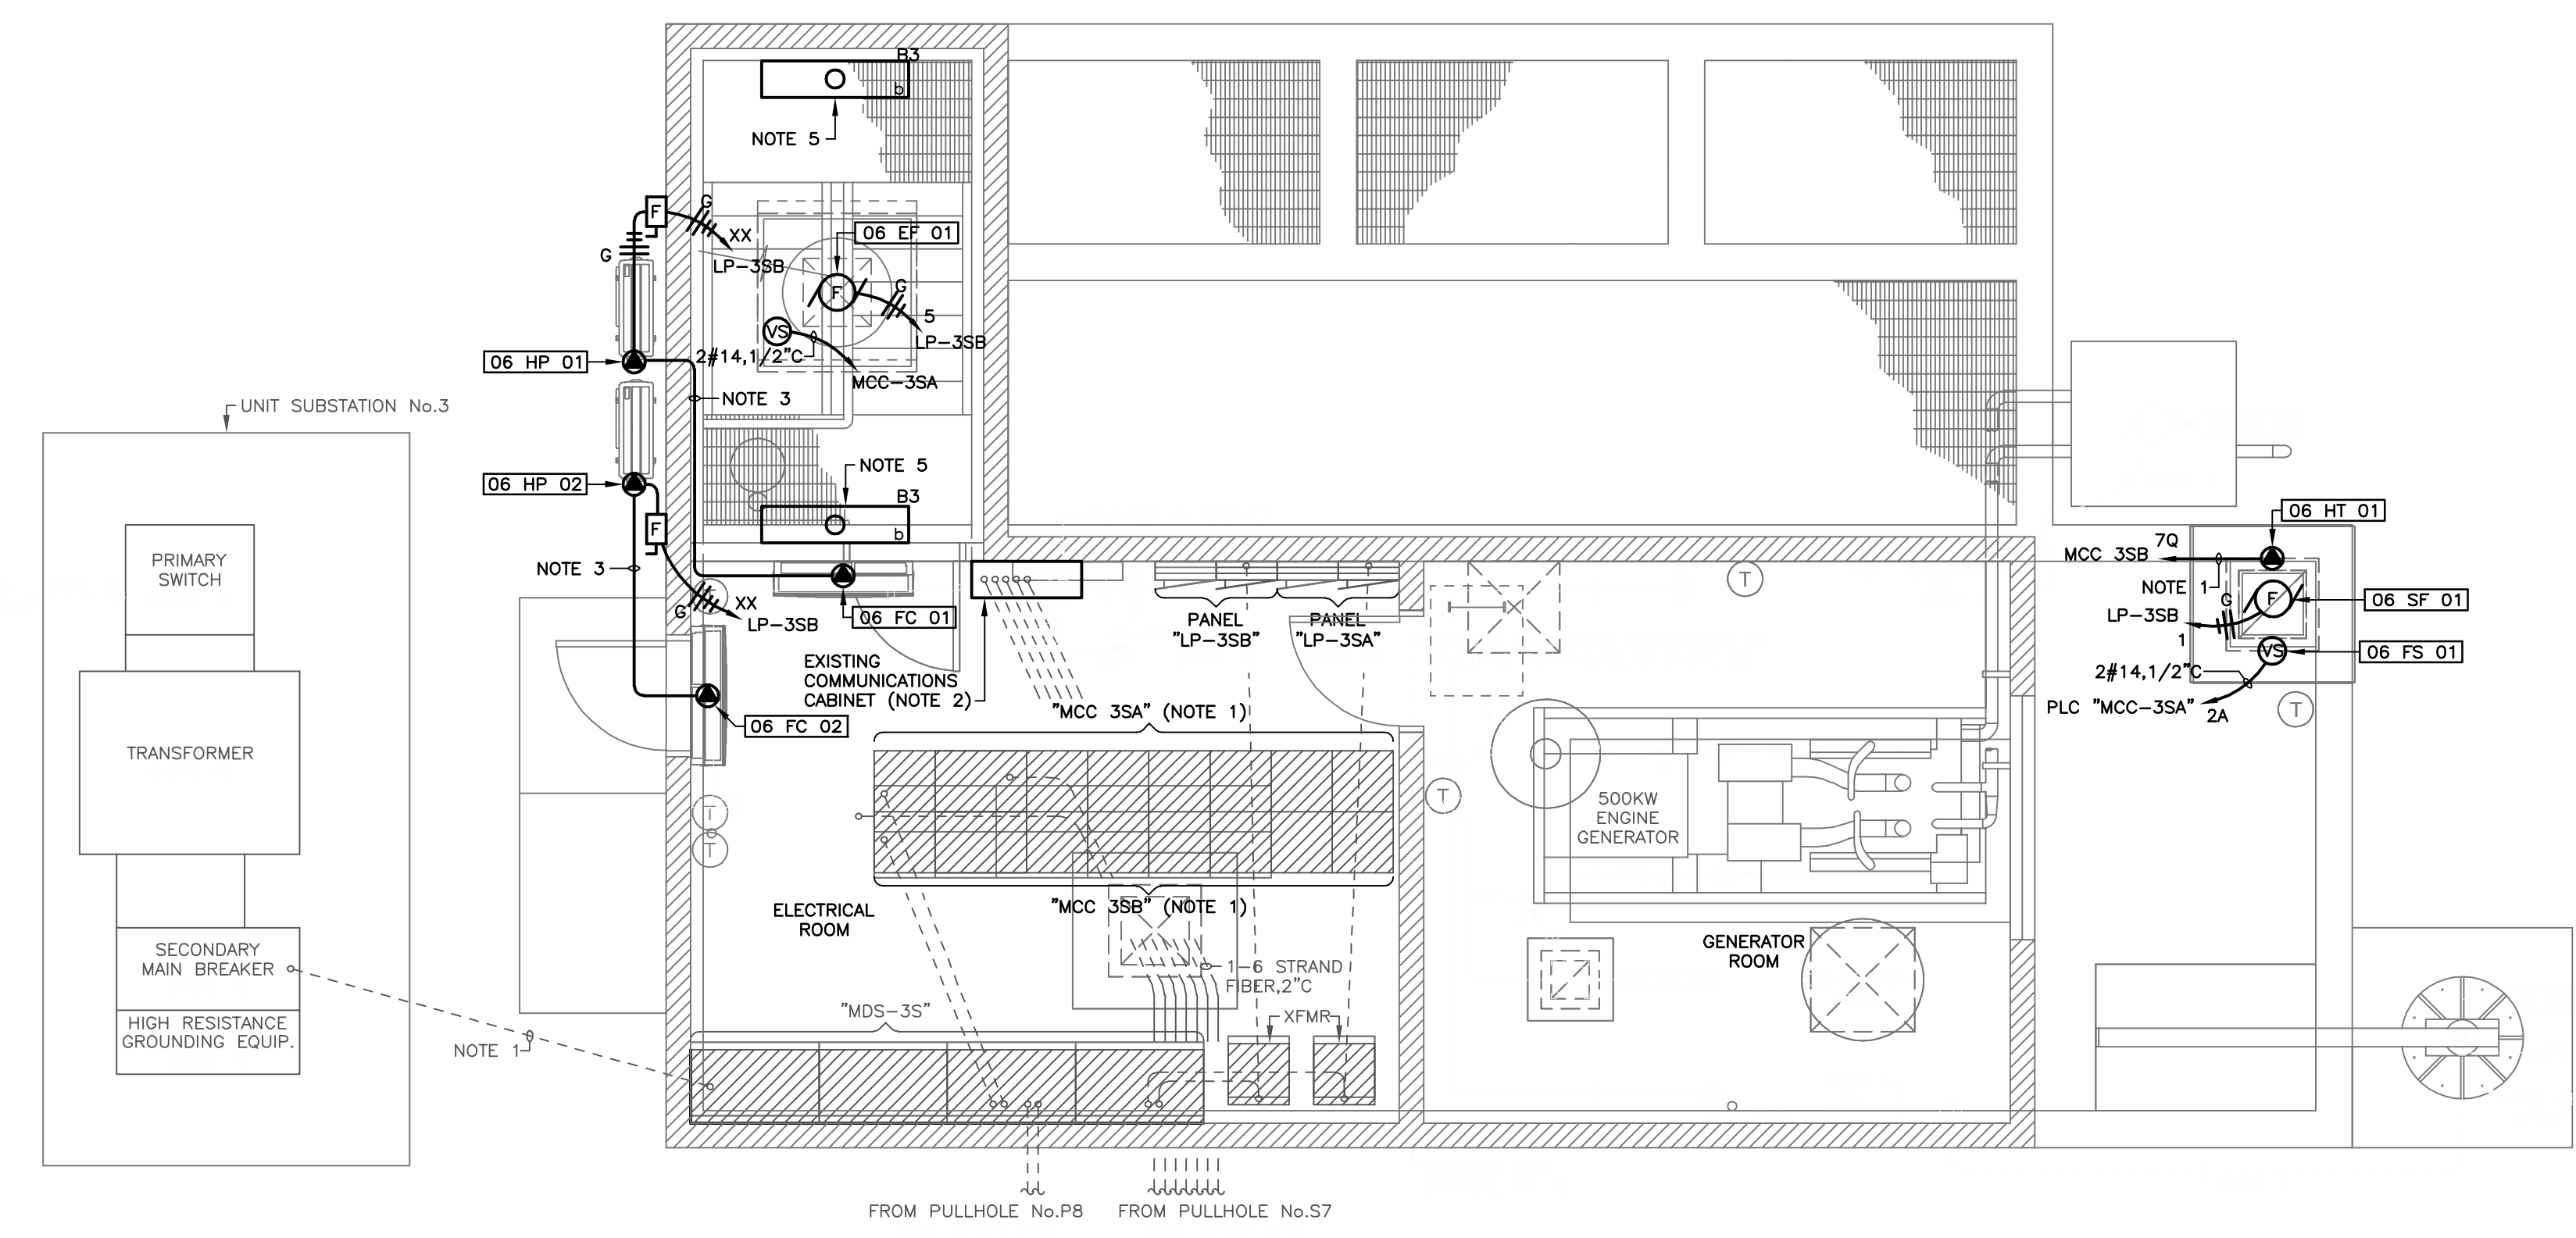

**MODIFIED ELECTRICAL PLAN
RAS/WAS BUILDING - MAIN LEVEL**
SCALE: 1/4" = 1'-0"



APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.




NOTES:

SEE DRAWING E-1 FOR GENERAL NOTES AND FOR GENERAL PLAN NOTES.

- SEE ONE LINE DIAGRAM DRAWING E-4 AS REFERENCED BY SCHEDULES ON E-2 FOR CIRCUIT AND EQUIPMENT INFORMATION.
- ROUTE CONDUITS ON EXISTING RACKS UNDER CEILING TO BELOW MCC-3SB, AD CONNECT TO EXISTING LABELED STUBOUTS UNDER THE MCC.
- ROUTE CONDUITS ON EXISTING RACKS UNDER CEILING TO BELOW THE PLC SECTION OF MCC-3SA. CORE DRILL THROUGH CEILING TO ROUTE CONDUITS INTO THE MCC SECTION.
- ROUTE CONDUITS ON EXISTING RACKS UNDER CEILING TO BELOW THE PANELBOARD. CORE DRILL THROUGH CEILING TO ROUTE CONDUITS UP INTO THE PANELBOARD. CONNECT FLOWMETER TO EXISTING CIRCUIT BREAKER AT POLE SPACE 17.

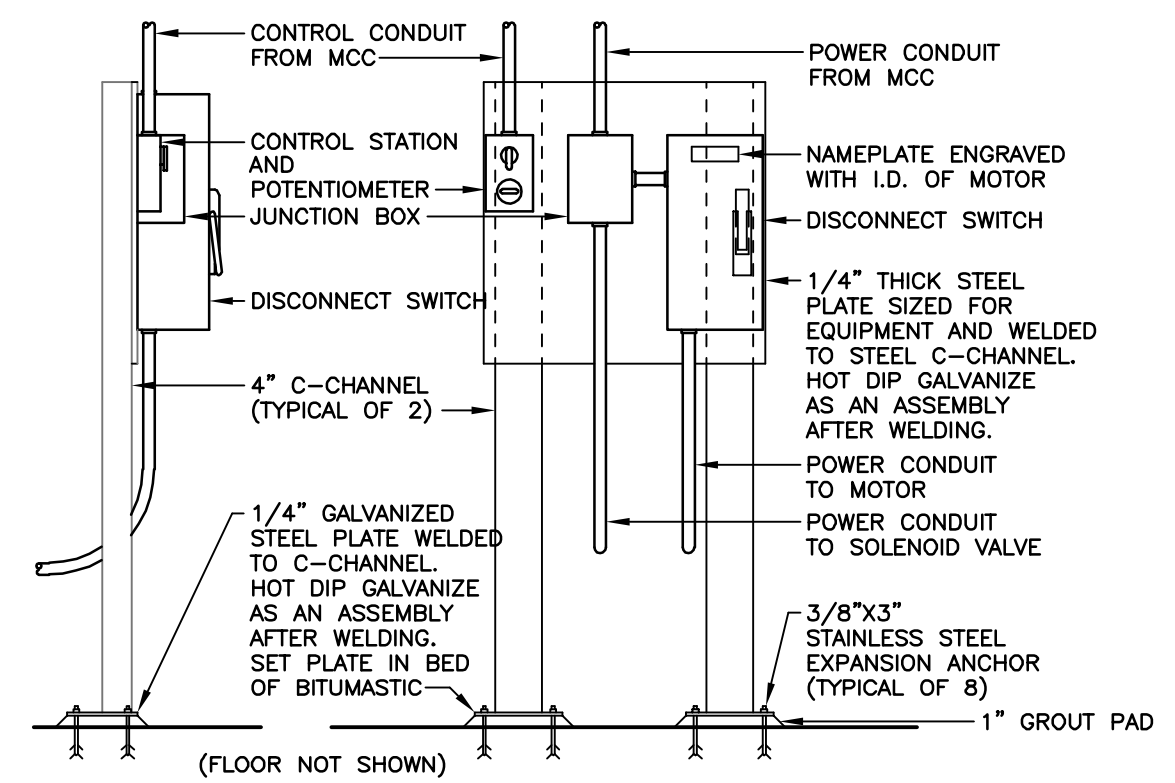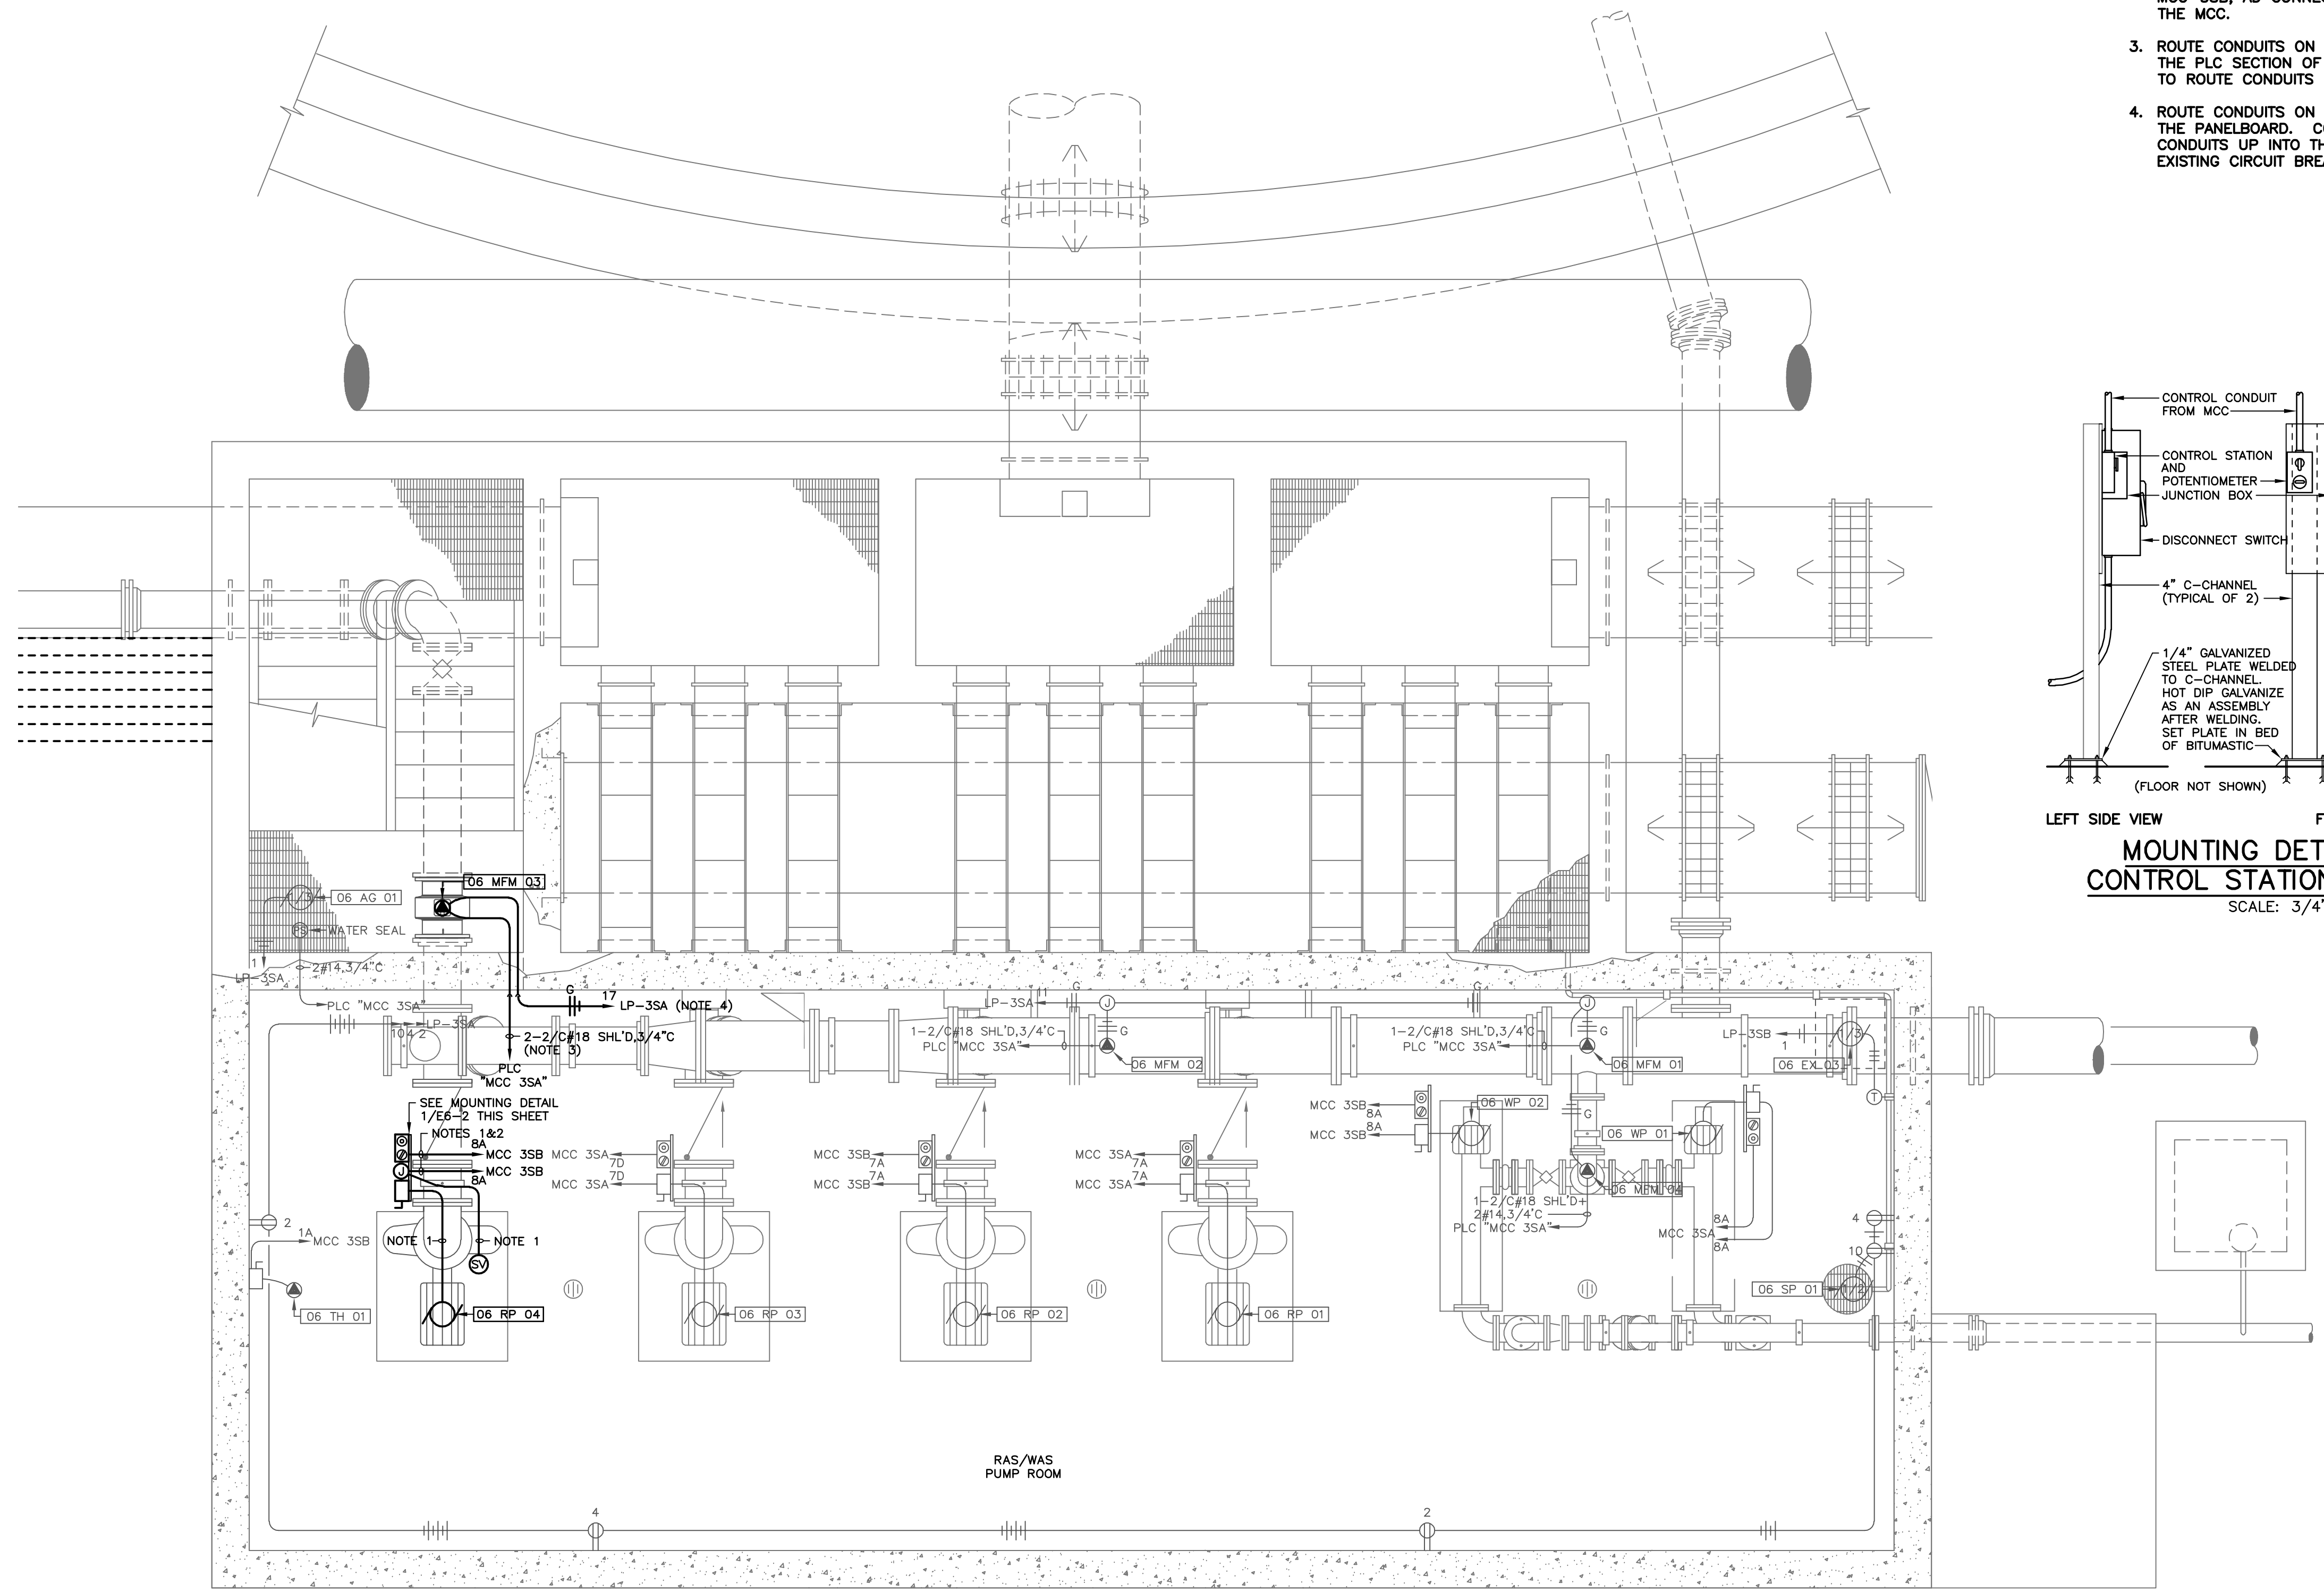


LEFT SIDE VIEW FRONT VIEW
MOUNTING DETAIL 1/E6-2
CONTROL STATION/DISCONNECT
SCALE: 3/4"=1'-0"

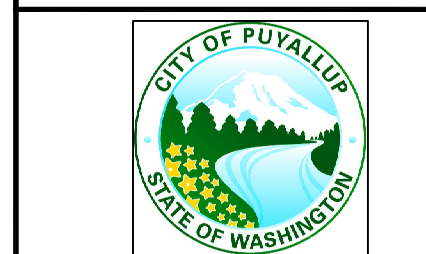

CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

PRELIMINARY
NOT FOR
CONSTRUCTION

No.	DATE	REVISION
ISSUED FOR: 90% DESIGN REVIEW		
ISSUE DATE: DECEMBER 2021		
APPROVED BY: DAB		
CHECKED BY: BBB		
DRAWN BY: DEK		
DESIGNER: DAB		
G & O JOB NO.: 21462		
FILE: 21462_E6-2.DWG		



ELECTRICAL
AREA 6

APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

EXIST/MODIFIED
RAS/WAS BUILDING
LOWER LEVEL

DRAWING: **E6-2** OF: **2**



EXISTING/MODIFIED ELECTRICAL PLAN
RAS/WAS BUILDING - LOWER LEVEL
SCALE: 3/8" = 1'-0"

Z:\J\OS\G&OS\21462\Cad\21462_E6-2.DWG, 1/3/2022 2:30 PM, DAVE A. BOWMAN


NOTES:

SEE DRAWING E-1 FOR GENERAL NOTES AND FOR GENERAL PLAN NOTES.


- SEE ONE LINE DIAGRAM DRAWING E-4 AS REFERENCED BY SCHEDULES ON E-2 FOR CIRCUIT AND EQUIPMENT INFORMATION.
- EXISTING 13.5 KV PRIMARY FEEDER CIRCUIT AND SPARE 4" C (OWNED BY CITY OF PUYALLUP) TO SUBSTATION NO.3. THIS CIRCUIT WILL NEED TO BE RELOCATED OUT OF THE FOUNDATION AREA FOR THE NEW CLARIFIER. EXACT ROUTING IS NOT KNOWN. CONTRACTOR IS RESPONSIBLE TO LOCATE AND REROUTE THIS CIRCUIT AS NECESSARY TO CONSTRUCT THE NEW CLARIFIER.
- ROUTE CIRCUIT MOUNTED TO UNDERSIDE OF CLARIFIER BRIDGE STRUCTURE.

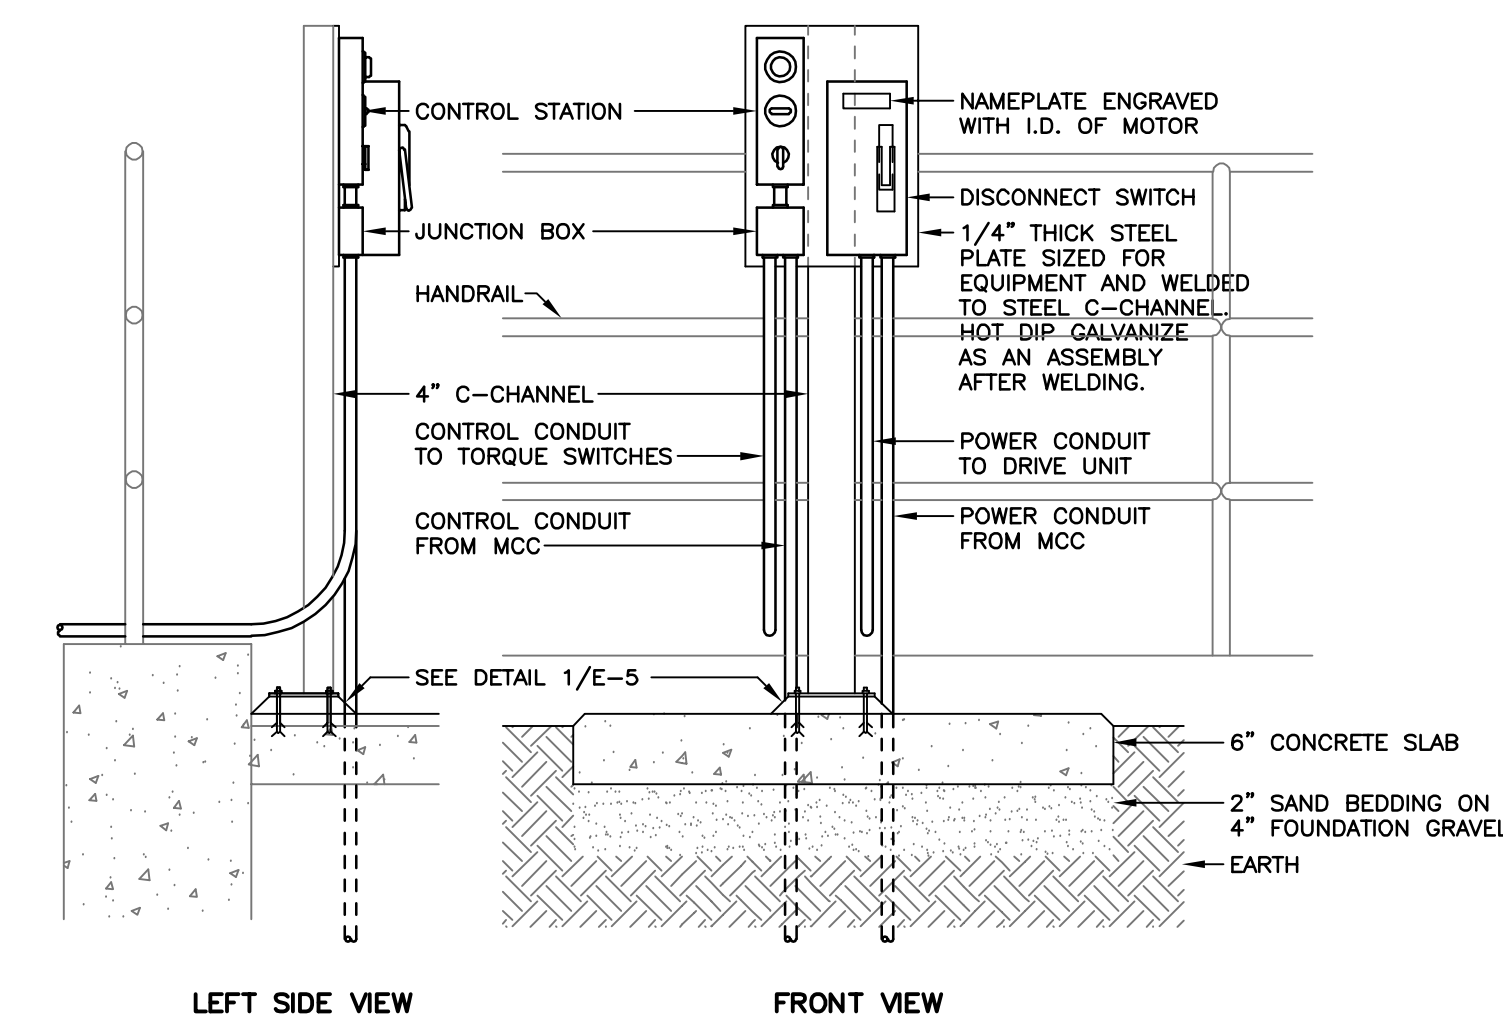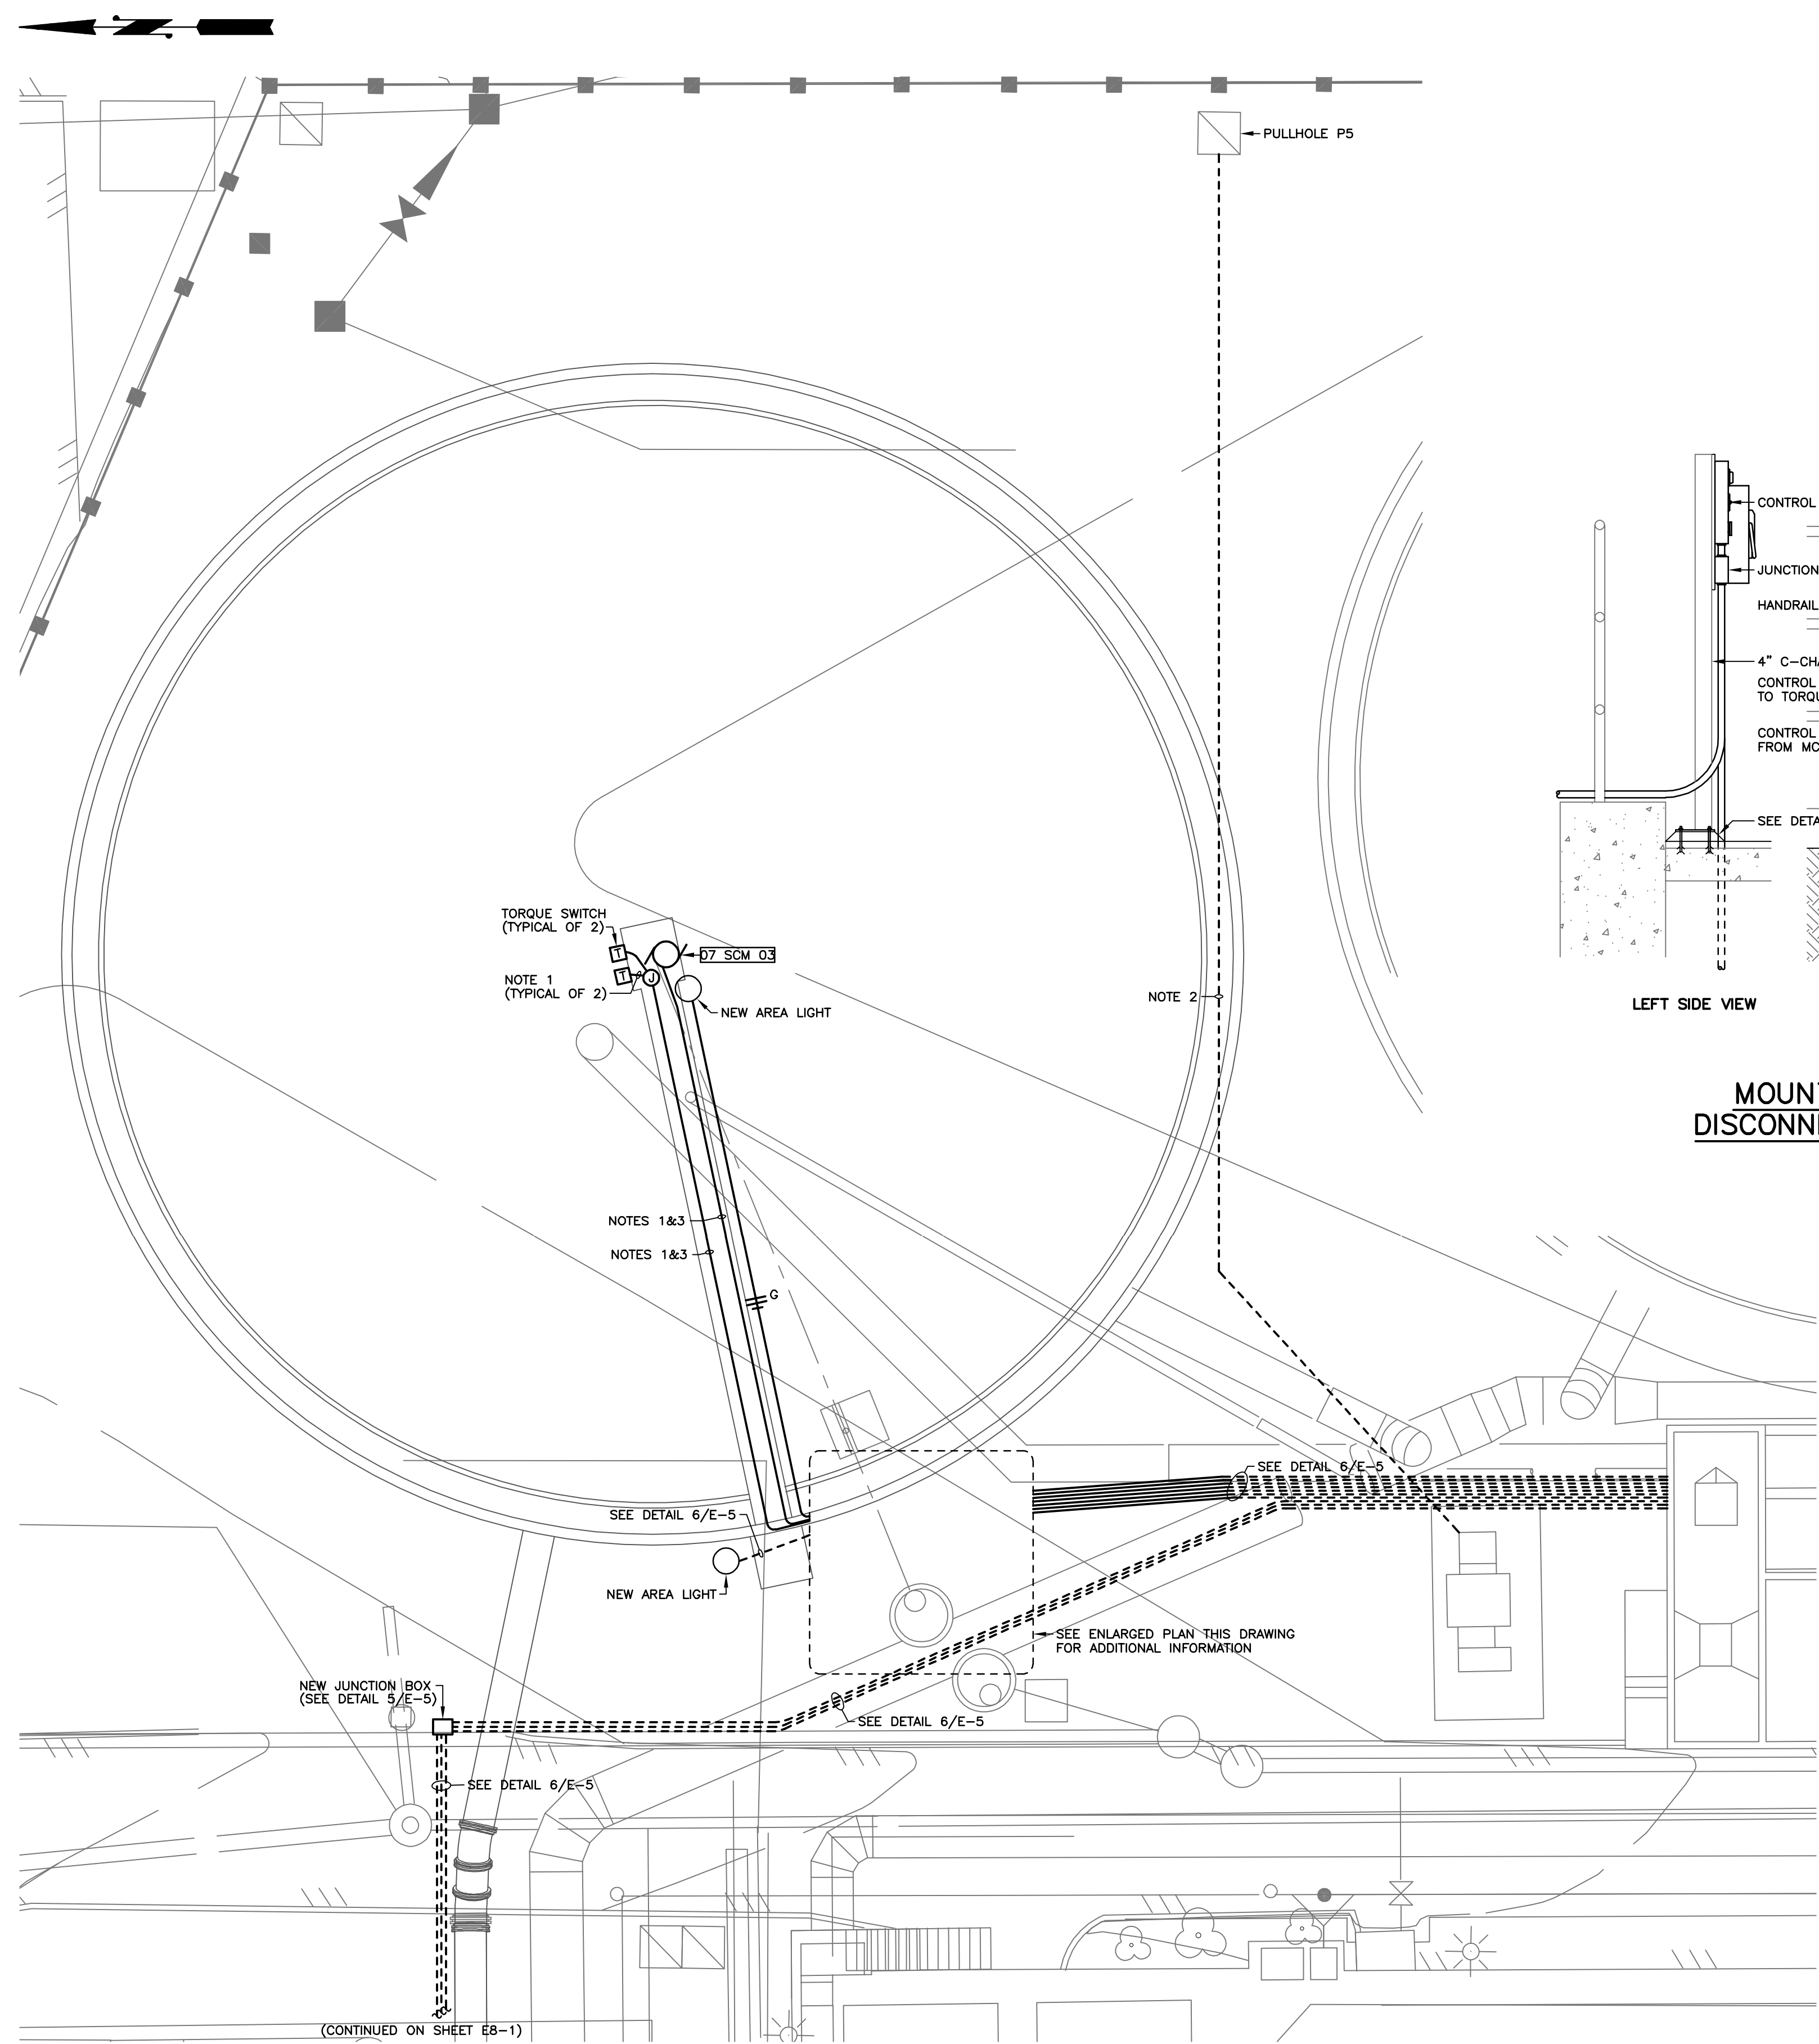

**MOUNTING DETAIL 1/E7-1
DISCONNECT/CONTROL STATION**
SCALE: 3/4"=1'-0"

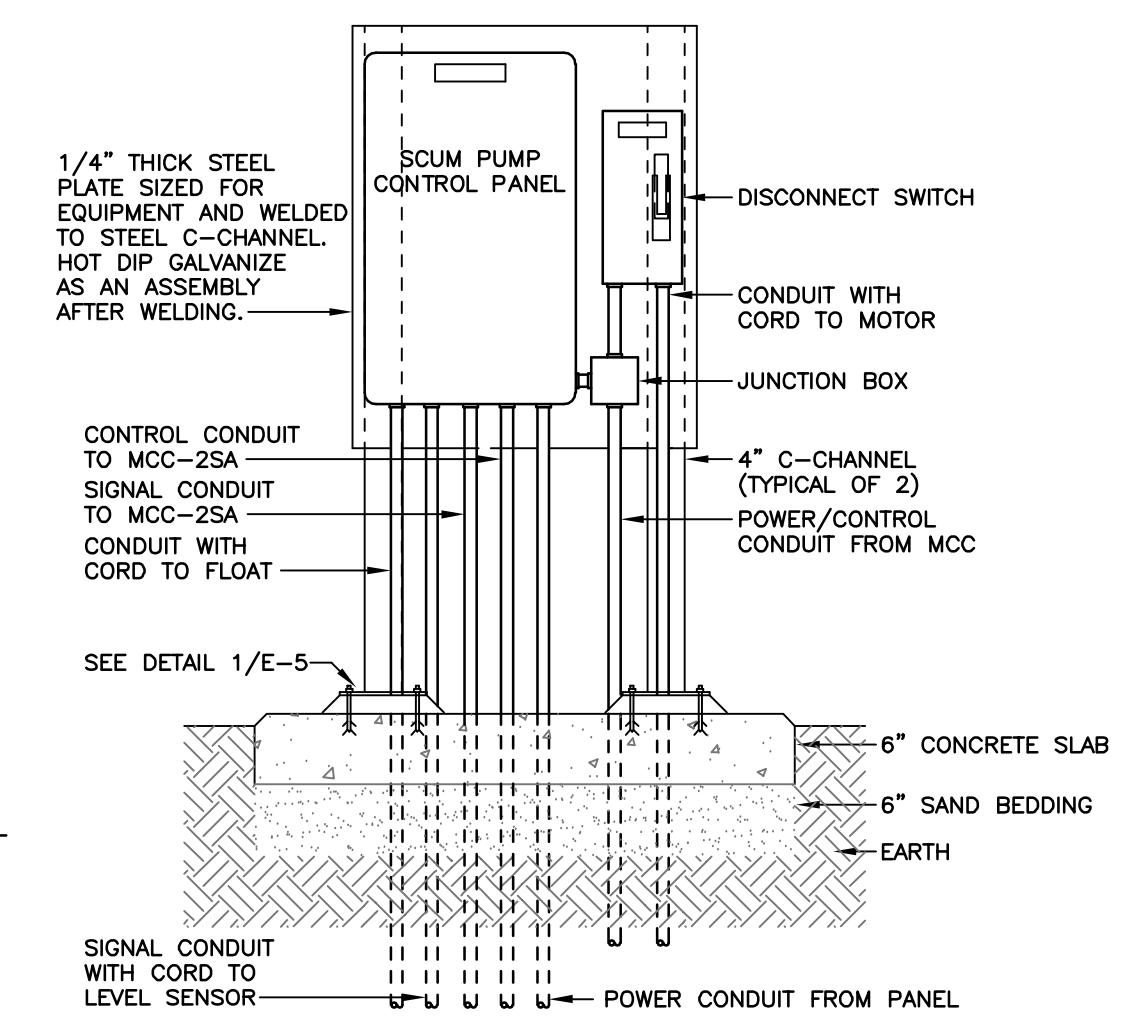

**MOUNTING DETAIL 2/E7-1
SCUM CONTROL PANEL**
SCALE: 3/4"=1'-0"

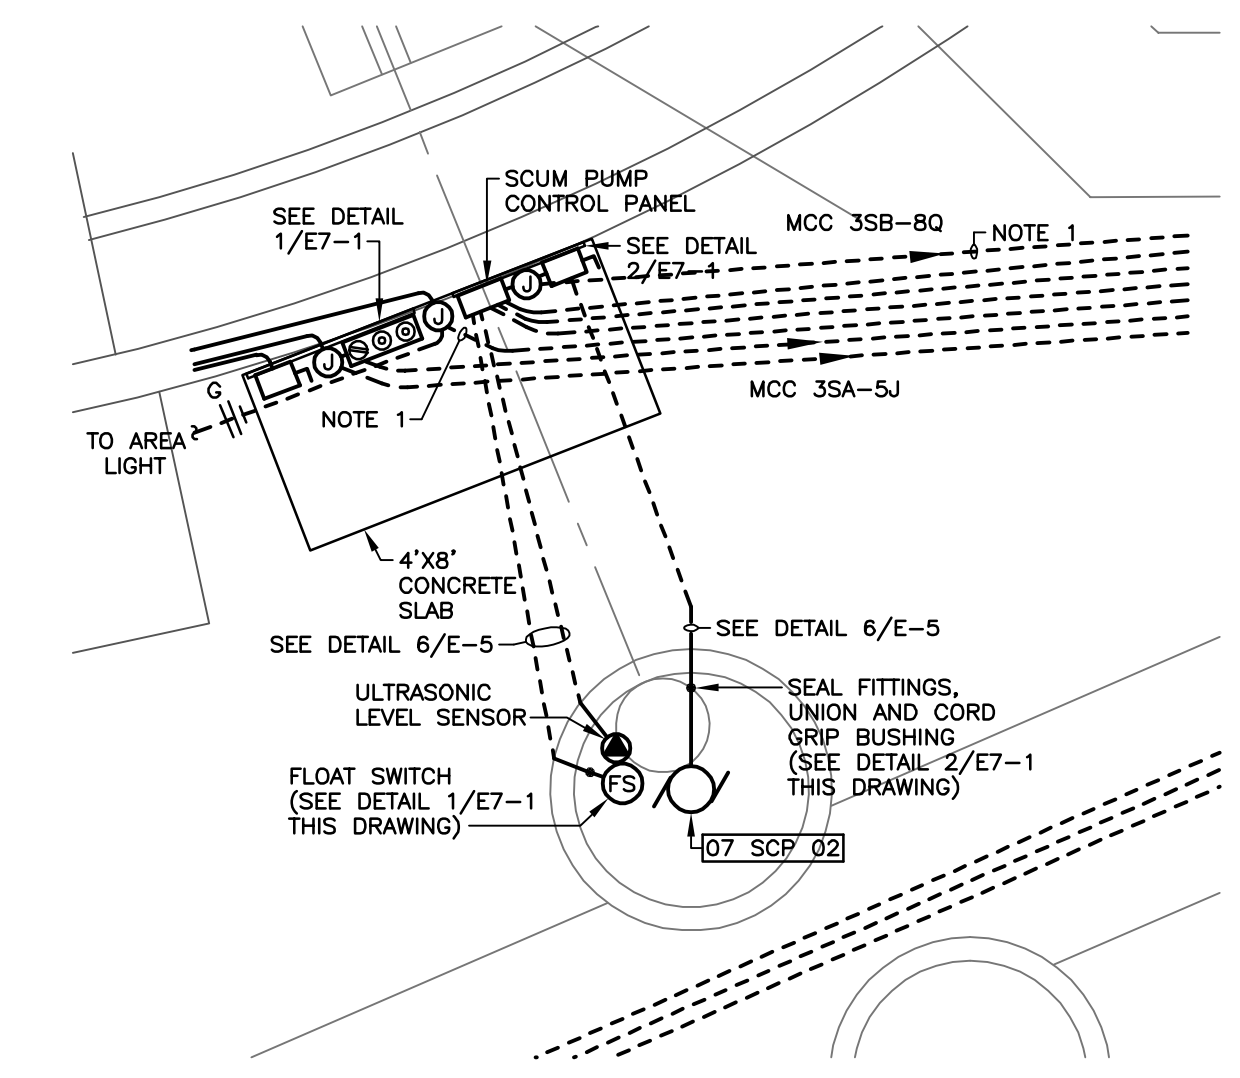

**ENLARGED ELECTRICAL PLAN
SCUM PUMP STATION**
SCALE: 1/4" = 1'




CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION

ISSUED FOR:
90% DESIGN REVIEW
ISSUE DATE: DECEMBER 2021
APPROVED BY: DAB
CHECKED BY: BBB
DRAWN BY: DEK
DESIGNER: DAB
G & O JOB NO.: 21462
FILE: 21462_E7-1.DWG



**ELECTRICAL
AREA 7**

**ELECTRICAL PLAN
CLARIFIER NO.3**

DRAWING: **E7-1** OF: **2**

APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

Z:\JUBS\G&OS\21462\Cad\21462_E7-1.DWG, 1/3/2022 2:31 PM, DAVE A. BOWMAN

(CONTINUED ON SHEET E8-1)



NOTES:

SEE DRAWING E-1 FOR GENERAL NOTES AND FOR GENERAL PLAN NOTES.

1. ROUTE CIRCUIT MOUNTED TO UNDERSIDE OF CLARIFIER BRIDGE STRUCTURE.



1130 RAINIER AVENUE SOUTH,
SUITE 300
SEATTLE, WASHINGTON 98144
(206) 284-0860




CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION


ISSUED FOR:
90% DESIGN REVIEW
ISSUE DATE: DECEMBER 2021
APPROVED BY: DAB
CHECKED BY: BBB
DRAWN BY: DEK
DESIGNER: DAB
G & O JOB NO.: 21462
FILE: 21462_E7-2.DWG

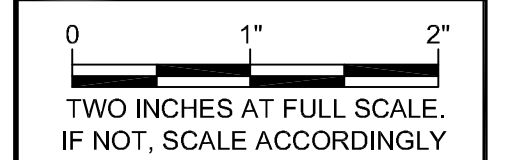

**ELECTRICAL
AREA 7**

**ELECTRICAL PLAN
EXISTING CLARIFIERS**

DRAWING: **E7-2** OF: **2**

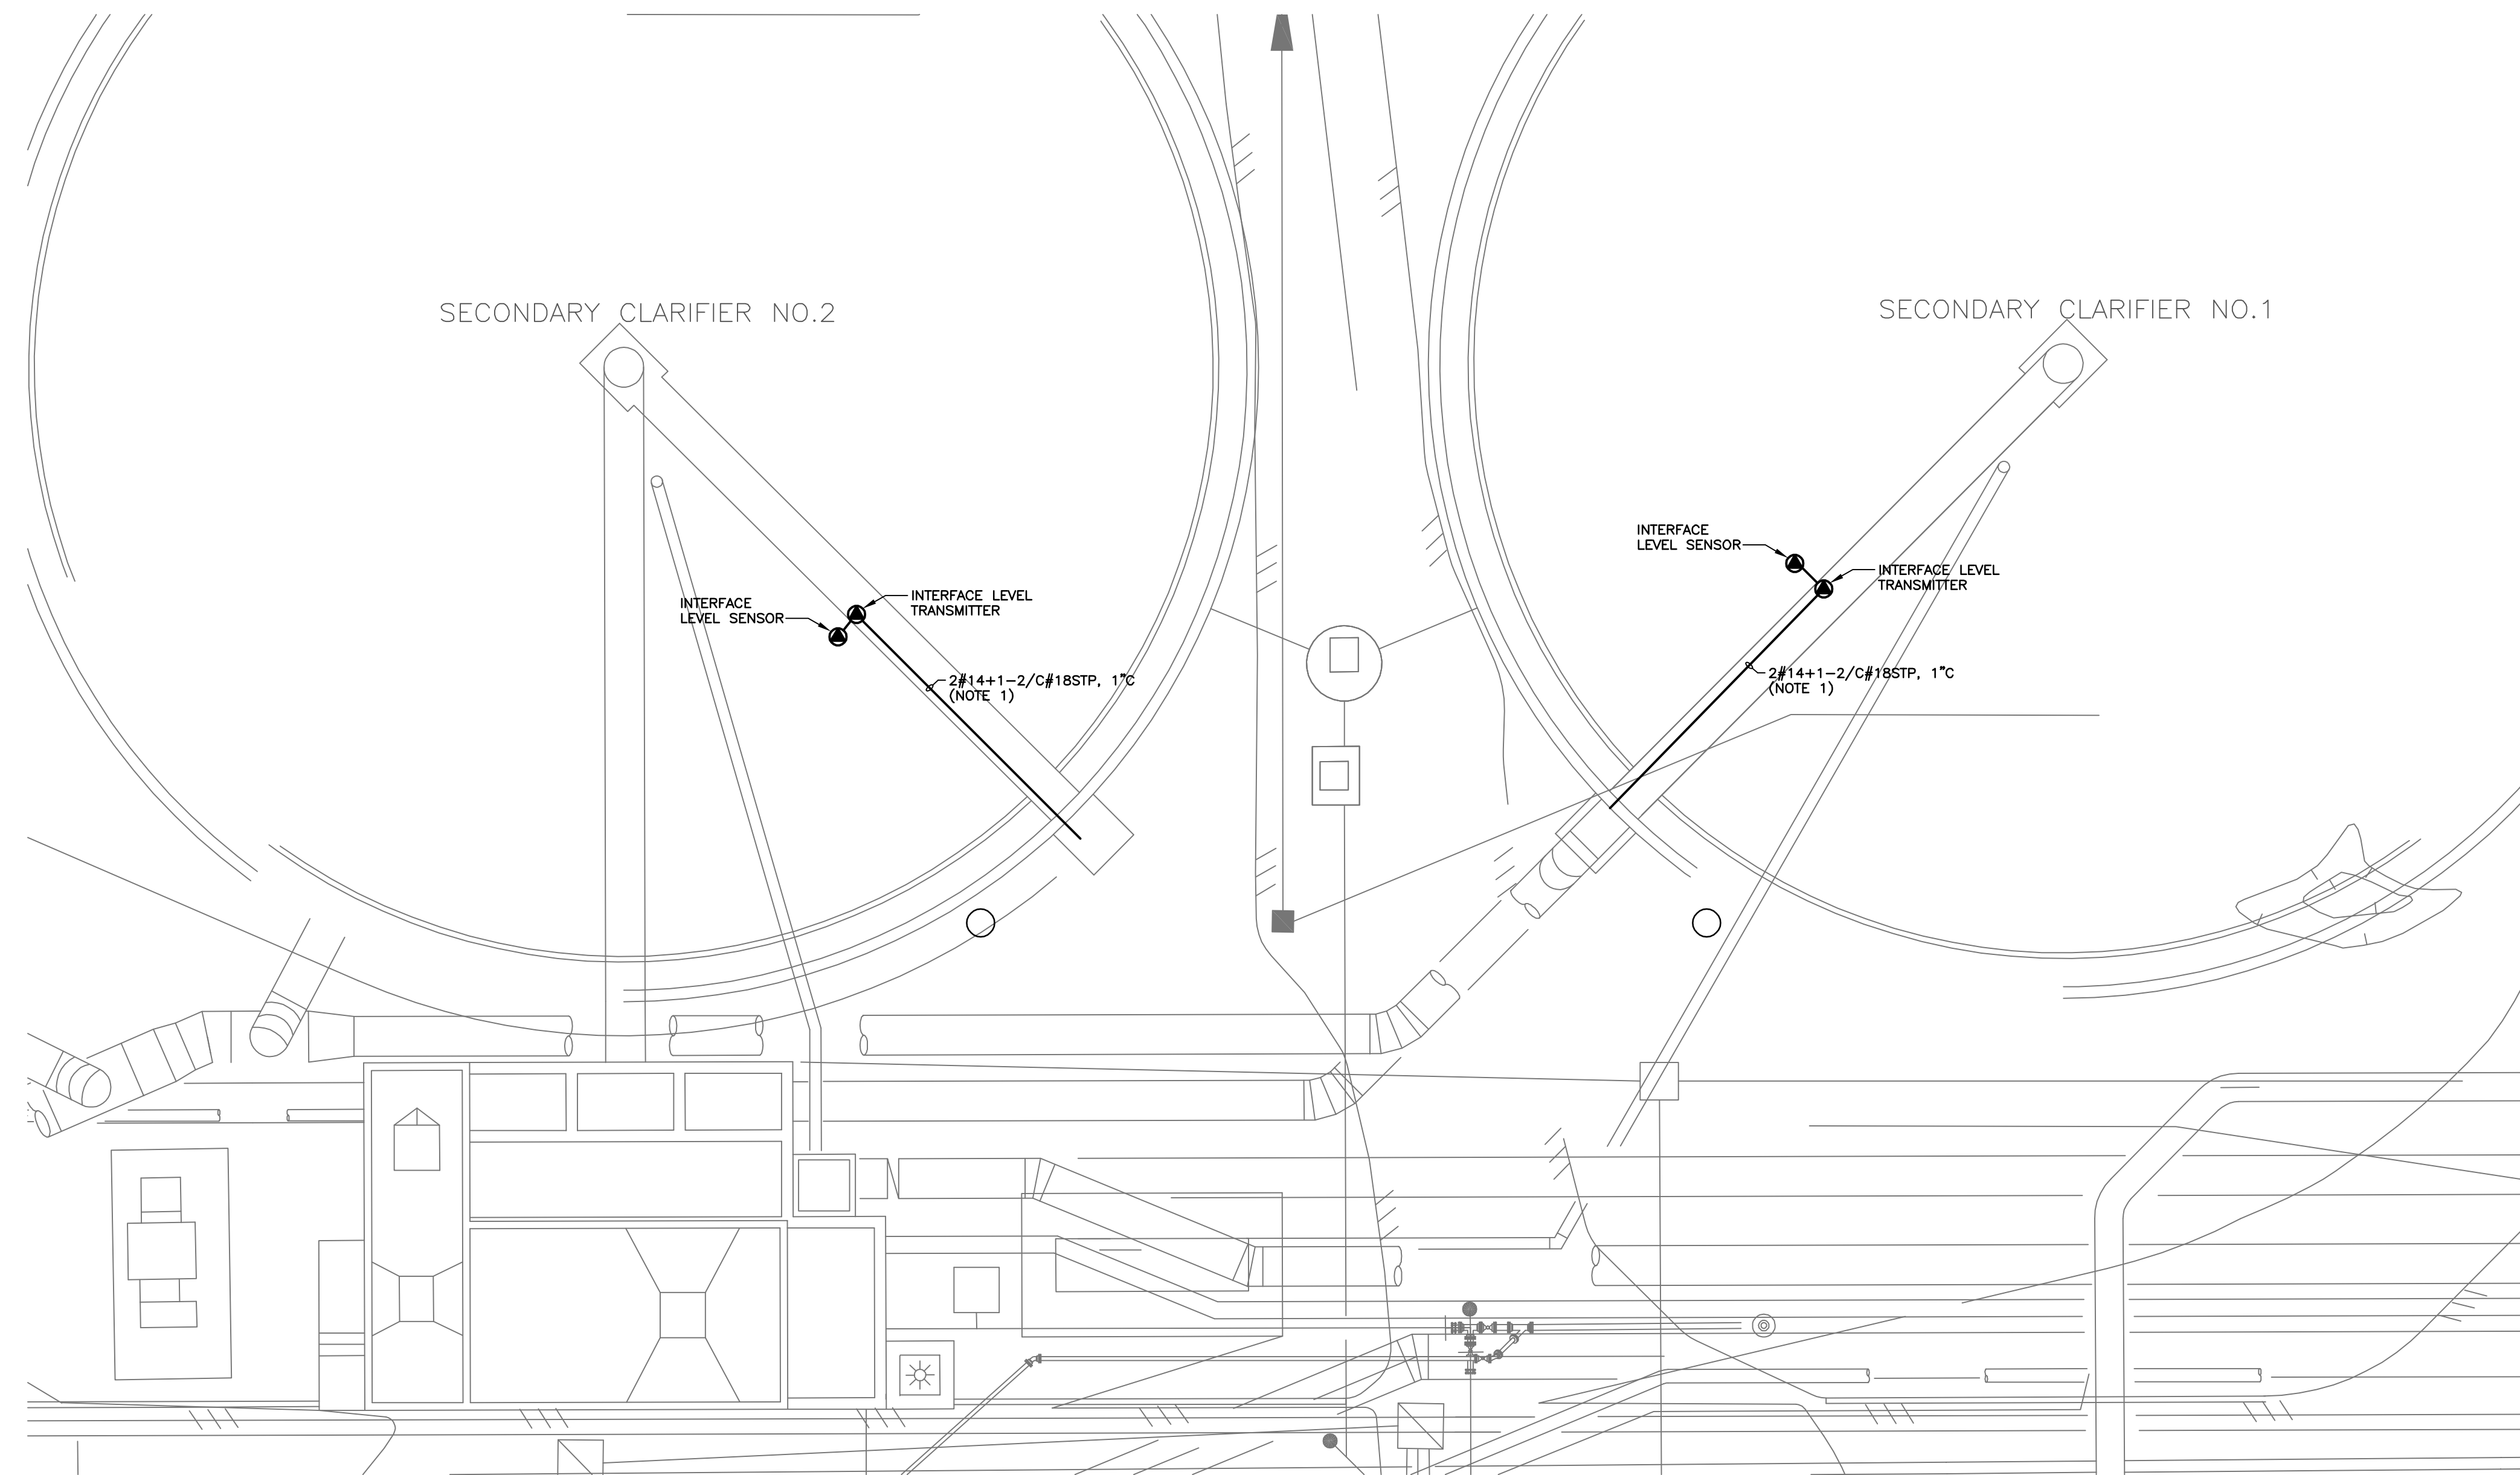

**ELECTRICAL PLAN
EXISTING CLARIFIERS**
SCALE: 1" = 10'

APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.




NOTES:

SEE DRAWING E-1 FOR GENERAL NOTES AND FOR GENERAL PLAN NOTES.

1. ROUTE CONDUIT ON WALL OF EFFLUENT PIPE GALLERY.
2. CORE DRILL WALL FOR CONDUIT PENETRATION AND SEAL WITH NON-SHRINK GROUT.
3. CAP SPARE 1" CONDUIT ABOVE GRADE.



1130 RAINIER AVENUE SOUTH,
SUITE 300
SEATTLE, WASHINGTON 98144
(206) 284-0860




CITY OF PUYALLUP
WATER POLLUTION
CONTROL PLANT THIRD
SECONDARY CLARIFIER
CIP NO. 20-018
1602 18TH ST NW,
PUYALLUP, WA 98371

**PRELIMINARY
NOT FOR
CONSTRUCTION**

No.	DATE	REVISION


ISSUED FOR:	90% DESIGN REVIEW
ISSUE DATE:	DECEMBER 2021
APPROVED BY:	DAB
CHECKED BY:	BBB
DRAWN BY:	DEK
DESIGNER:	DAB
G & O JOB NO.:	21462
FILE:	21462_E8-1.DWG

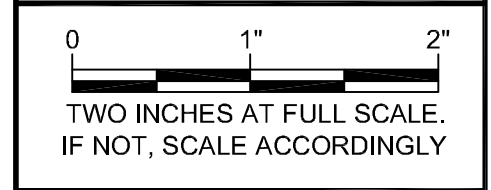

**ELECTRICAL
AREA 8**

**ELECTRICAL PLAN
EFFLUENT
FLOWMETER**

DRAWING: **E8-1** OF: **1**

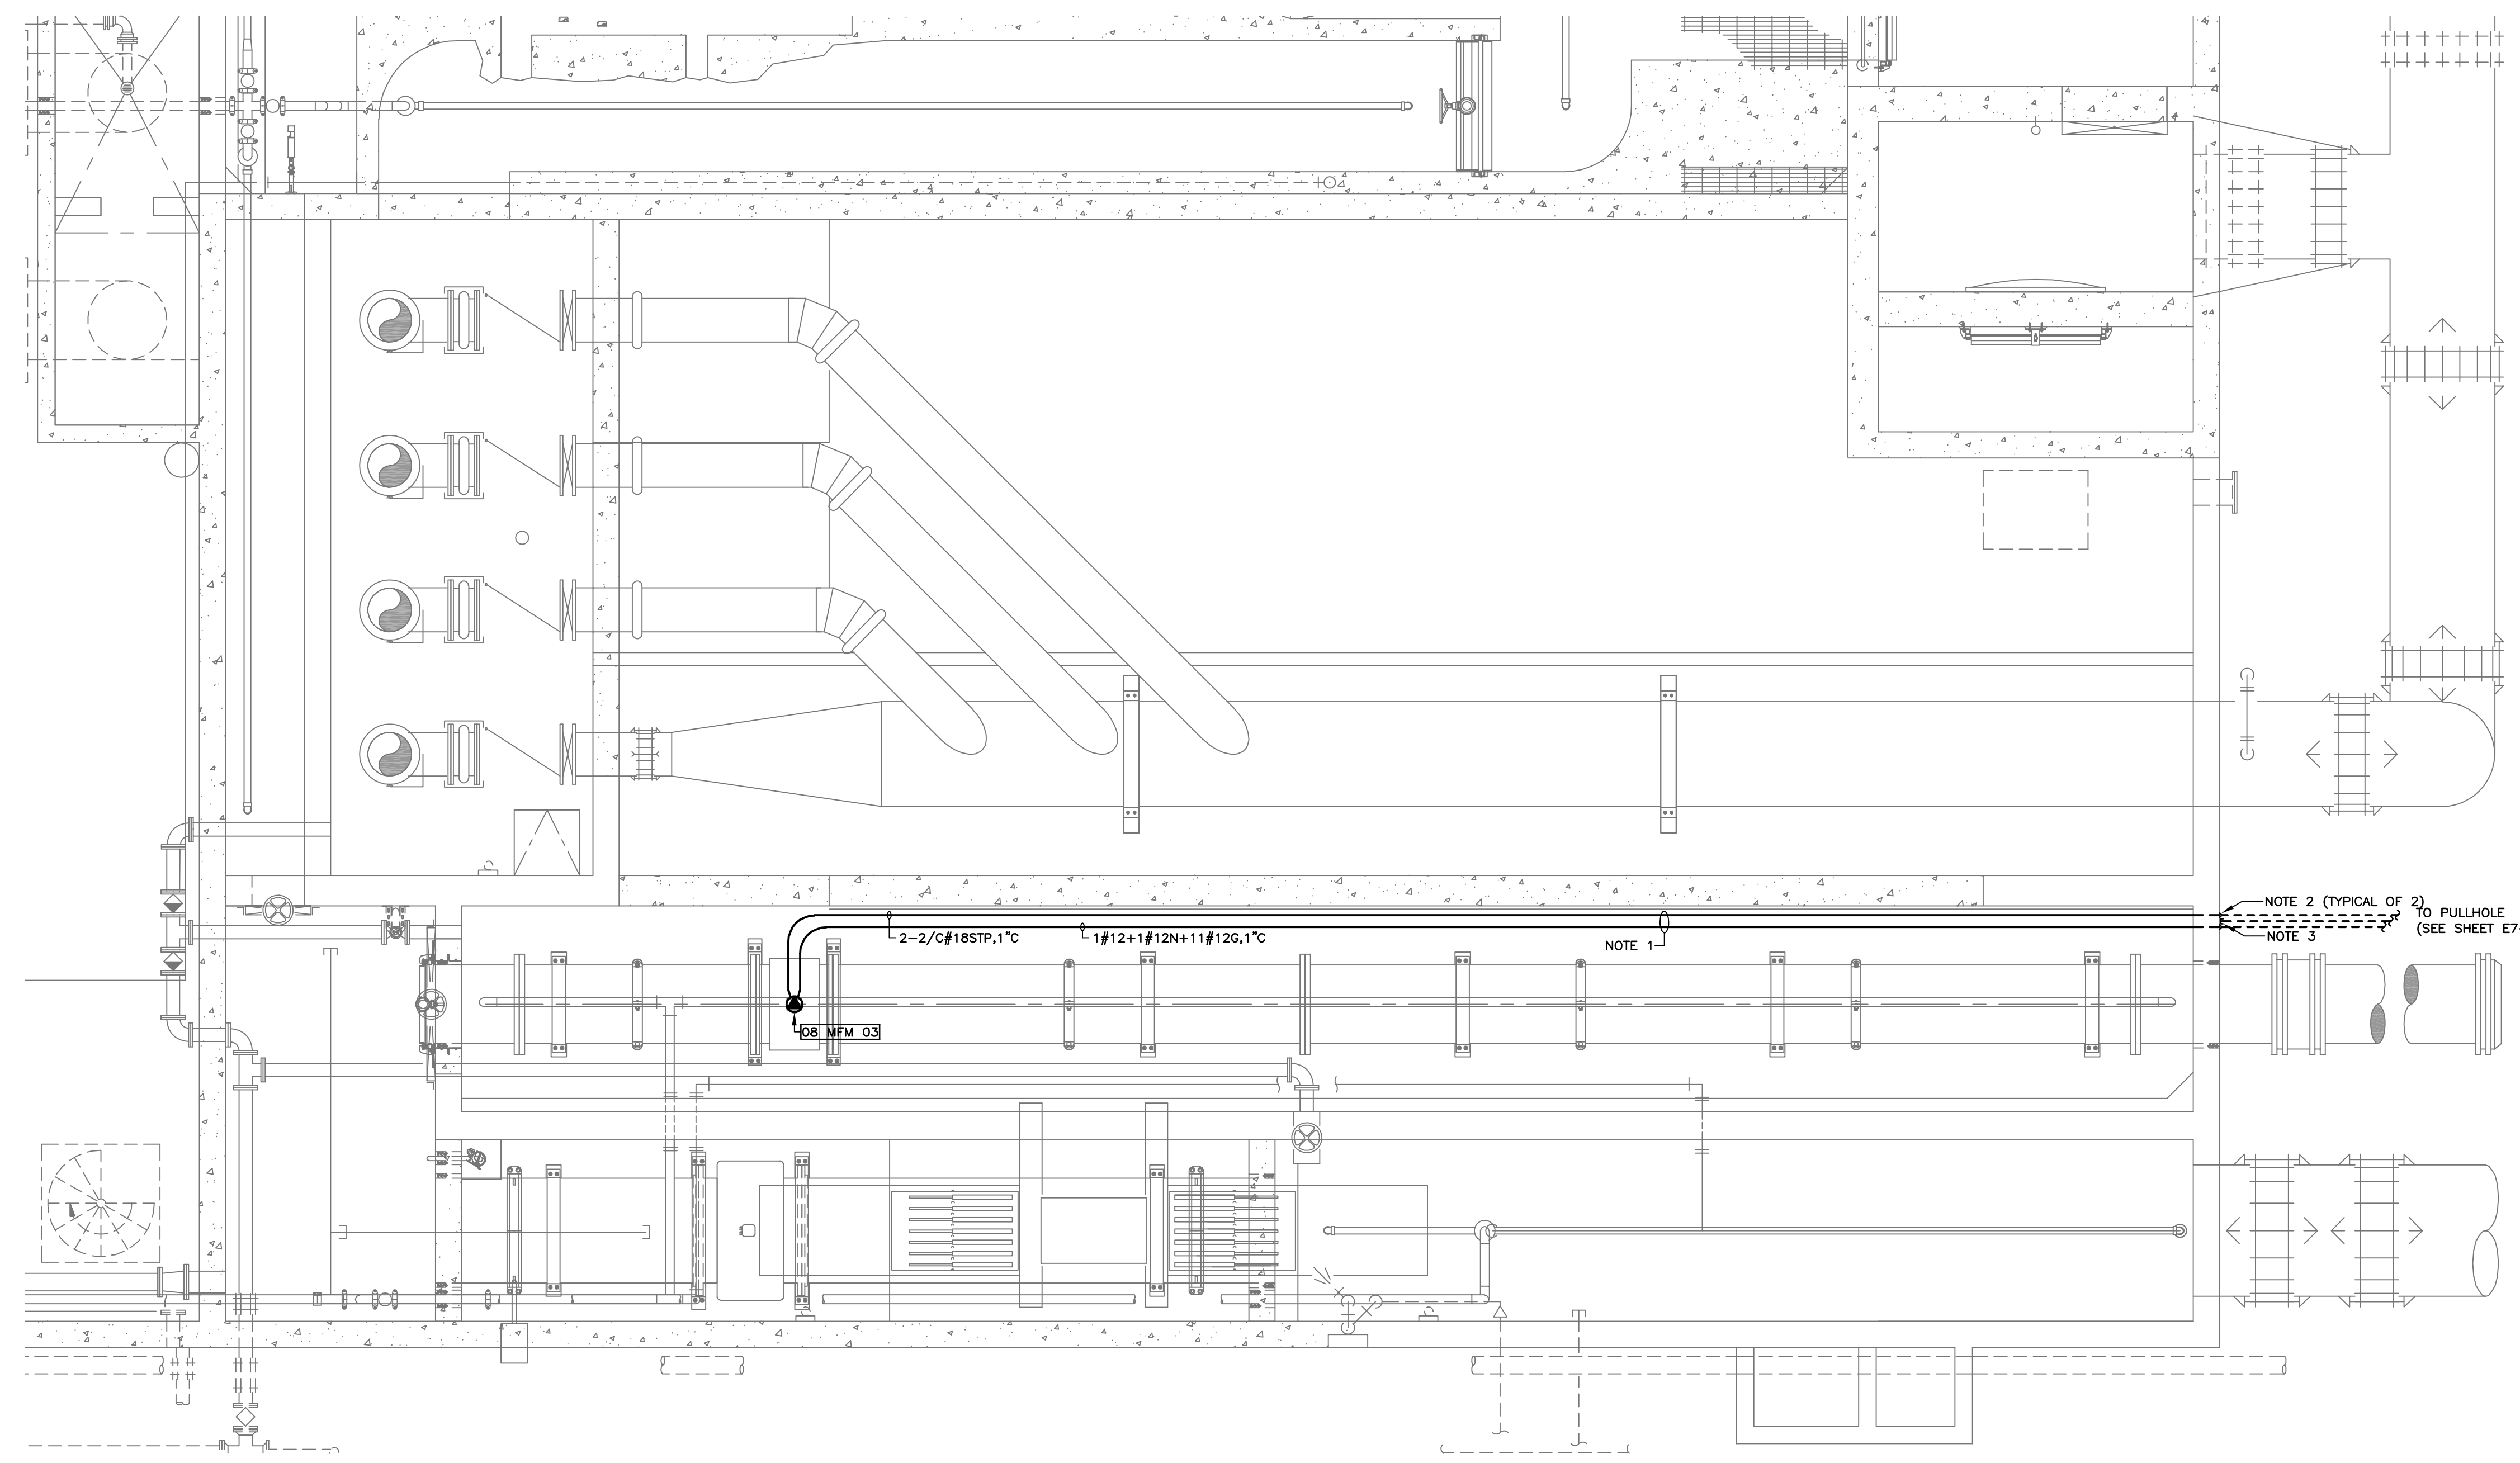

**ELECTRICAL PLAN
EFFLUENT FLOWMETER**
SCALE: 1/4" = 1'-0"

APPROVED
BY: _____
CITY ENGINEER
CITY OF PUYALLUP
APPROVED
DATE: _____
EXPIRATION
DATE: _____
NOTE: This approval expires on the date shown. If construction has not started by expiration date, plans must be resubmitted for review and approval.
The City will not be responsible for errors and/or omissions on these plans.
Field conditions may dictate changes to these plans as determined by the City Engineer.

Z:\J\OS\G&OS\21462\Cad\21462_E8-1.DWG, 1/3/2022 2:33 PM, DAVE A. BOWMAN