COVER SHEET
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

SURVEY INFORMATION:

PURPOSE OF THIS SURVEY
THE PURPOSE OF THIS SURVEY IS TO SHOW EXISTING CONDITIONS FOR DEVELOPMENT AND/OR DESIGN

BASIS NAD83(2011) DATUM PER WASHINGTON STATE REFERENCE NETWORK(WSRN)
BASIS NAD83(2011) DATUM WAS ESTABLISHED BY HOLDING WSRN OBSERVATIONS ON MONUMENTS, SAID DIMENSIONS AS SHOWN HEREON.

PROJECT BASE POINT
LATITUDE: N47.213701882
LONGITUDE: W122.320606588
HEIGHT: -40.000000
PROJECT COMBINED SCALE: 1.0000232619

VERTICAL DATUM IS NAVD88 PER WSRN TIED TO GEOID18

LOCAL SITE/PROJECT BENCHMARKS
AS SHOWN ON THIS SURVEY (SEE SHEETS C4–C6)

SITE ADDRESS	ASSESSOR'S PARCEL NUMBER	PARCEL AREA
4723 FREEMAN ROAD E.	042017–4075	223,187± SQ. FT. OR 5.123± ACRES
4801 FREEMAN ROAD E.	042020–1039	73,861± SQ. FT. OR 1.696± ACRES
4815 FREEMAN ROAD E.	042020–1066	16,128± SQ. FT. OR 0.370± ACRES
4823 FREEMAN ROAD E.	042020–1034	22,055± SQ. FT. OR 0.506± ACRES
4827 FREEMAN ROAD E.	042020–1052	19,821± SQ. FT. OR 0.455± ACRES
4917 FREEMAN ROAD E.	042020–1045	NO TITLE REPORT
4923 FREEMAN ROAD E.	042020–1027	49,753± SQ. FT. OR 1.142± ACRES
5117 FREEMAN ROAD E.	042020–5003	74,635± SQ. FT. OR 1.713± ACRES
5005 FREEMAN ROAD E.	042020–1036	83,200± SQ. FT. OR 1.910± ACRES
5109 FREEMAN ROAD E.	042020–5004	30,928± SQ. FT. OR 0.710± ACRES
8307 52ND STREET E.	042020–1101	217,704± SQ. FT. OR 4.998± ACRES
8305 49TH STREET E.	042020–1040	45,227± SQ. FT. OR 1.038± ACRES
8315 49TH STREET E.	042020–5016	43,118± SQ. FT. OR 0.990± ACRES
8218 49TH STREET E.	042020–1042	56,740± SQ. FT. OR 1.303± ACRES
8319 49TH STREET E.	042020–5017	47,539± SQ. FT. OR 1.091± ACRES

FLOOD INFORMATION
PARCEL IS LOCATED IN ZONE "X" – AREA OF MINIMAL FLOOD HAZARD.
PER FEMA PANEL NUMBER 53053C0329E, DATED 3/7/2017.

REFERENCE SURVEYS
R1) RECORD OF SURVEY, REC. NO. 200812225002
R2) RECORD OF SURVEY, REC. NO. 200510205004
R3) SHORT PLAT, REC. NO. 9403231137
R4) SHORT PLAT, REC. NO. 8009260306
R5) RECORD OF SURVEY, REC. NO. 3204
R6) RECORD OF SURVEY, REC. NO. 201311085007

REFERENCE GIS DATA
G1) GIS MAP PROVIDED OR DOWNLOADED ON 4/30/2021 FROM PUGET SOUND ENERGY.

NOTES
1. ALL DISTANCES SHOWN ON THIS SURVEY ARE IN US SURVEY FOOT.

2. UTILITIES ARE SHOWN PER SURFACE OBSERVATIONS, UTILITY PAINT MARKINGS PER PRIVATE UTILITY LOCATOR ENLISTED AS PART OF THIS SURVEY AND PERFORMED BY APPLIED PROFESSIONAL SERVICES INC. AND OTHER REFERENCE INFORMATION. QUOTED ACCURACY OF UTILITIES SHOWN PER UTILITY LOCATE PAINT MARKINGS ARE 1.5'± HORIZONTALLY. VERTICAL UTILITY INFORMATION IS SHOWN TO THE SIGNIFICANT FIGURE AT WHICH THEY WERE MEASURED, BUT INHERENT ERROR EXISTS IN RESTRICTION OF ACCESS TO UNDERGROUND UTILITIES. UTILITIES SHOWN PER REFERENCE INFORMATION ARE PER BEST FIT AND INTERPOLATION AND SHOULD BE VERIFIED PRIOR TO CONSTRUCTION. FOR EXACT UTILITY DEPTH AND LOCATION INFORMATION, IT IS RECOMMENDED THAT POTHOLING BE PERFORMED.

LOCATOR NOTE: WAS UNABLE TO LOCATE WELLS AND POWER TO WELLS DUE TO ACCESS ISSUES.

3. FIELD SURVEY WAS COMPLETED IN APRIL 2021 AND ALL MONUMENTS SHOWN AS FOUND WERE VISITED AT THIS TIME OR AS NOTED.

4. THIS SURVEY IS A RETRACEMENT OF THE DEEDED DESCRIPTION STATED ABOVE AND DOES NOT PURPORT TO SHOW ANY UNRECORDED OWNERSHIP RIGHTS.

5. FIRST AMERICAN TITLE INSURANCE COMPANY, ORDER/COMMITMENT NOS.

4269–3710994, DATED MARCH 22, 2021 8:00 AM,
4269–3711001, DATED MARCH 15, 2021 8:00 AM.
4269–3358130, DATED NOVEMBER 12, 2019 8:00 AM,
4266–3319199, DATED SEPTEMBER 06, 2019 8:00 AM,
4266–3346938, DATED OCTOBER 22, 2019 8:00 AM,
4266–3348684, DATED OCTOBER 24, 2019 8:00 AM,
4269–3445550, DATED APRIL 03, 2020 8:00 AM,
4269–3456051, DATED APRIL 20, 2020 8:00 AM,
4269–3458157, DATED APRIL 21, 2020 8:00 AM,
4269–3514609, DATED JUNE 23, 2020 8:00 AM,
4269–3644487, DATED DECEMBER 17, 2020 8:00 AM,

WERE RELIED UPON FOR TITLE INFORMATION ON THIS SURVEY.

6. NO EVIDENCE OF RECENT EARTHWORK WITH THE SITE WAS OBSERVED.

7. NO INFORMATION REGARDING PROPOSED CHANGES IN STREET RIGHT OF WAY LINES WAS MADE AVAILABLE.

8. NO INDICATIONS OF WETLANDS WERE OBSERVED ON THE SUBJECT PROPERTY.

9. THERE IS NO EVIDENCE OF SITE USE AS A DUMP, SUMP, OR SANITARY LANDFILL.

10. NO ZONING INFORMATION PROVIDED BY INSURER.

11. PARKING EXISTS ON SITE, THERE ARE NO DELINEATED PARKING SPACES,

PROCEDURE / NARRATIVE:
A FIELD TRAVERSE USING A TRIMBLE S7 & SX10 ROBOTIC TOTAL STATION AND DATA COLLECTOR SUPPLEMENTED WITH FIELD NOTES AND SPECTRA PRECISION SP80 NETWORK RTK GPS ROVER, WAS PERFORMED, ESTABLISHING THE ANGULAR, DISTANCE, AND VERTICAL RELATIONSHIPS BETWEEN THE MONUMENTS, PROPERTY LINES AND IMPROVEMENTS. THE RESULTING DATA MEETS OR EXCEEDS THE STANDARDS FOR LAND BOUNDARY SURVEYS AS SET FORTH IN WAC 332–130–090.

SOILS REPORT NOTES:

1. THE FOLLOWING SOILS REPORT FOR THE SITE SHALL BE CONSIDERED PART OF THESE CONSTRUCTION DOCUMENTS:

SOILS REPORT: GEOTECHNICAL ENGINEERING REPORT
FREEMAN LOGISTICS
FREEMAN ROAD EAST AND 19TH AVENUE NORTHWEST
PUYALLUP, WASHINGTON
PROJECT NO. T–8565

PREPARED BY: TERRA ASSOCIATES, INC.
12220 113TH AVENUE NE, SUITE 130
KIRKLAND, WA 98034
PH: (425) 821–7777

2. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE THAT ALL PROVISIONS OF THE SOILS REPORT FOR THE SITE BE OBSERVED AND COMPLIED WITH DURING ALL PHASES OF THE SITE PREPARATION, GRADING OPERATIONS, FOUNDATION, SLAB, AND PAVING CONSTRUCTION.

3. ANY PROVISIONS OF THE SOILS REPORT WHICH CONFLICT WITH INFORMATION SHOWN ELSWHERE ON THESE DRAWINGS, OR WHICH REQUIRE FURTHER CLARIFICATION, SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER FOR DETERMINATION.

4. A REPRESENTATIVE OF THE SOILS ENGINEER SHALL BE AVAILABLE TO OBSERVE AND APPROVE THE EARTHWORK OPERATIONS AND TO VERIFY FIELD CONDITIONS AS WORK PROCEEDS. THE SOILS ENGINEER SHALL SUBMIT FIELD REPORTS CERTIFYING THAT THE METHODS AND MATERIALS OF THE EARTHWORK OPERATIONS WERE IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE SOILS INVESTIGATION AND THAT THE WORK WAS PERFORMED TO HIS/HER SATISFACTION.

5. THE SOILS ENGINEER SHOULD BE NOTIFIED AT LEAST FIVE (5) WORKING DAYS PRIOR TO ANY SITE CLEARING OR GRADING.

6. SOILS PLACED IN STRUCTURAL AREAS SHOULD BE PLACED IN LOOSE LIFTS OF 12 INCHES OR LESS AND COMPACTED TO A RELATIVE COMPACTION OF 90 PERCENT, BASED ON THE LABORATORY MAXIMUM DRY DENSITY AS DETERMINED BY THE MODIFIED PROCTOR METHOD (ASTM D–1557). FOR SOIL PLACED IN UTILITY TRENCHES UNDERLYING STRUCTURAL AREAS, COMPACTION REQUIREMENTS ARE DICTATED BY THE LOCAL CITY, COUNTY, OR UTILITY DISTRICT, AND IN GENERAL ARE SPECIFIED AS 95 PERCENT RELATIVE COMPACTION. STRUCTURAL FILL PLACED WITHIN THE UPPER 12 INCHES OF SLAB–ON–GRADE AND PAVEMENT SUBGRADE AREAS SHOULD BE COMPACTED TO A RELATIVE COMPACTION OF AT LEAST 95 PERCENT.

ESTIMATED EARTHWORK QUANTITIES:

CY CUT: 40,710
CY FILL: 45,600
CY NET: 4,890 CY (FILL)
AREA TO BE DISTURBED = 26.30 AC

EARTHWORK QUANTITIES ARE APPROXIMATE AND HIGHLY DEPENDENT ON SOIL CONDITIONS ENCOUNTERED DURING CONSTRUCTION. CONTRACTOR SHOULD PERFORM INDEPENDENT ESTIMATE FOR BIDDING.

SITE PLAN NOTE:

SITE PLAN HAS BEEN PROVIDED BY SYNTHESIS, PLLC.
BARGHAUSEN CONSULTING ENGINEERS, INC. HAS NOT VERIFIED THE ACCURACY OF THE SITE PLAN.

EXISTING TOPOGRAPHY/SURVEY INFORMATION NOTE:

SURVEY DATED FEBRUARY 28, 2022 WAS COMPLETED BY TREVOR S. LANKTREE, P.L.S. OF LANKTREE LAND SURVEYING, INC. BARGHAUSEN HAS NOT VERIFIED THE ACCURACY OR COMPLETENESS OF THE INFORMATION SHOWN. SITE DESIGN HAS BEEN BASED ON ABOVE REFERENCED SURVEY.

HORIZONTAL CONTROL NOTE:

CONTRACTOR SHALL HAVE ALL PROPERTY LINES, CURB, SIDEWALK, STRUCTURES, CONCRETE PADS AND ANY OTHER ABOVE GROUND PERMANENT STRUCTURE DEPICTED ON THESE PLANS STAKED FOR CONSTRUCTION BY A LICENSED SURVEYOR. LICENSED SURVEYOR SHALL STAKE ALL ITEMS USING COORDINATE GEOMETRY (RECTIFIED TO SITE CONTROL) CONTAINED IN CAD DRAWING FILES PROVIDED BY BARGHAUSEN CONSULTING ENGINEERS, INC. IT IS THE CONTRACTOR'S RESPONSIBILITY TO RETRIEVE LATEST CAD FILES FROM BARGHAUSEN CONSULTING ENGINEERS INC., REFLECTING ANY ISSUED PLAN REVISIONS. BARGHAUSEN CONSULTING ENGINEERS SHALL IMMEDIATELY BE NOTIFIED OF ANY DISCREPANCIES PRIOR TO THE START OF CONSTRUCTION.

EXISTING LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

SURVEY MONUMENT (AS NOTED)
SECTION CORNER (AS NOTED)
SET REBAR/CAP (LS#45789)
FOUND REBAR/CAP (AS NOTED)
SET 2"x2" HUB/TACK LINE STAKE
MAG/WASHER OR LEAD/TACK (AS NOTED)
BENCHMARK
LUMINAIRE (LUM.)
YARD LIGHT
ORNAMENTAL LIGHT
TRAFFIC SIGNAL LIGHTS
POWER METER
POWER POLE
JUNCTION BOX (AS NOTED)
TELEPHONE MANHOLE
CATCH BASIN (CB)
STORM MANHOLE (SDMH)
SANITARY SEWER MANHOLE (SSMH)
CLEANOUT (AS NOTED)
GAS METER
GAS VALVE
WATER VALVE (WV)
FAUCET
FIRE HYDRANT(FH) / CONNECTION(FDC)
WATER MANHOLE
WATER METER
BLOW–OFF / AIRVAC
MONITOR WELL
SIGN
IRRIGATION SPRINKLER
DIRECTIONAL ARROW
HANDICAP
CHAIN LINK FENCE
WOOD FENCE
HOGWIRE FENCE
SILT FENCE
METAL/IRON FENCE
GUARD RAIL/CABLE FENCE
WATER LINE
GAS LINE
STEAM LINE
T(XX) TELEPHONE LINE (OH) OR (UG)
P(XX) POWER LINE (OH) OR (UG)
SD STORM LINE
SS SEWER LINE
ROCKERY
KEYSTONE WALL
DECIDUOUS TREE
CONIFEROUS TREE
TREE DRIPLINE
CONCRETE
GRAVEL/SAND (AS NOTED)
ASPHALT
BUILDING LINE

PROPOSED LEGEND:


(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

TYPE II CATCH BASIN
TYPE I CATCH BASIN
STORM DRAIN FLOW ARROW
STORM DRAINAGE LINE
SANITARY SEWER LINE
SANITARY SEWER CLEANOUT
FIRE HYDRANT
WATER VALVE
CONCRETE BLOCKING
90° BEND
SPOT ELEVATIONS 300.48
CONTOURS 150
WOODEN FENCE
WHEEL STOP
ASPHALT PAVEMENT
CONCRETE PAVEMENT

UTILITY CONFLICT NOTE:


CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1–800–424–5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

ENGINEER'S REVIEW
☐ APPROVED
☐ APPROVED AS CORRECTED
☐ REVISE AND RESUBMIT
☐ REJECTED
☑ FOR INFORMATION ONLY
The City's review is not a confirmation of any dimension or quantities shown in the plans and will not relieve the Developer or Engineer from responsibility for plan errors. No changes shall be made to the plans except with the consent of the City Engineer. If construction has not commenced within a reasonable period of the approval date, plans will require re-approval by the City.
BY kosborne DATE 9/11/2025

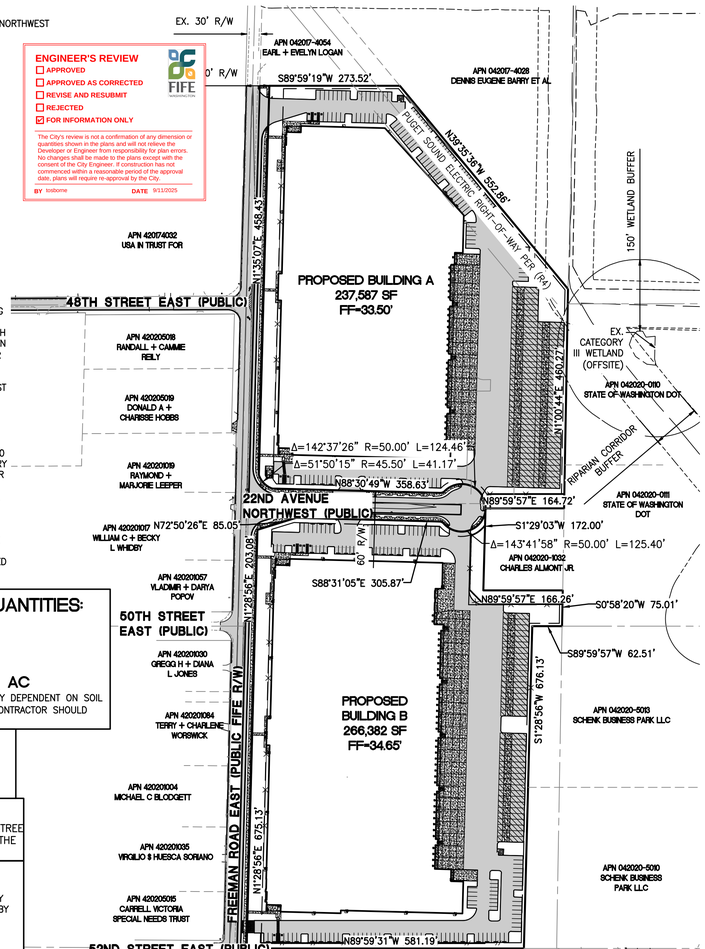

LIDAR DISCLAIMER:

NOTE: PORTIONS OF THE INFORMATION ON THIS DRAWING HAVE BEEN CREATED USING A SUBSET OF DATA OBTAINED FROM THE PUGET SOUND LIDAR CONSORTIUM AND/OR WASHINGTON DEPARTMENT OF NATURAL RESOURCES, AND HAS NOT BEEN INDEPENDENTLY VERIFIED BY BARGHAUSEN CONSULTING ENGINEERS, LLC. THIS DATA IS PROVIDED FOR YOUR INFORMATION ONLY. BARGHAUSEN CONSULTING ENGINEERS, LLC DOES NOT ASSUME ANY LIABILITY FOR ANY ERRORS, OMISSIONS OR INACCURACIES IN THE LIDAR INFORMATION SHOWN HEREON OR THE USE THEREOF.

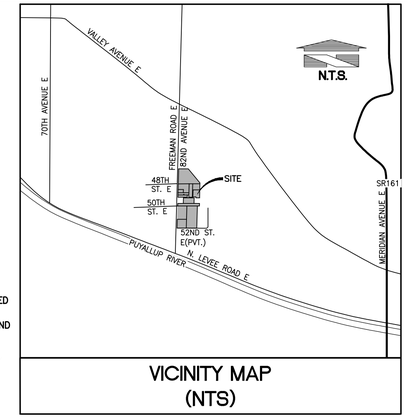

VICINITY MAP
(NTS)

GENERAL SITE NOTES:

1. THE CONTRACTOR SHALL OBTAIN AND HAVE AVAILABLE COPIES OF THE APPLICABLE GOVERNING AGENCY STANDARDS AT THE JOB SITE DURING THE RELATED CONSTRUCTION OPERATIONS.

2. CONTRACTOR SHALL ENSURE THAT ALL NECESSARY PERMITS HAVE BEEN OBTAINED PRIOR TO COMMENCING WORK.

3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION AND DEPTH OF ALL EXISTING UTILITIES PRIOR TO CONSTRUCTION WHETHER SHOWN ON THESE PLANS OR NOT. UTILITIES OTHER THAN THOSE SHOWN MAY EXIST ON THIS SITE. ONLY THOSE UTILITIES WITH EVIDENCE OF THEIR INSTALLATION VISIBLE AT GROUND SURFACE OR SHOWN ON RECORD DRAWING PROVIDED BY OTHERS ARE SHOWN HEREON. EXISTING UNDERGROUND UTILITY LOCATIONS SHOWN ARE APPROXIMATE ONLY AND ARE SUBJECT TO A DEGREE OF UNKNOWN VARIATION. SOME UNDERGROUND LOCATIONS SHOWN HEREON MAY HAVE BEEN TAKEN FROM PUBLIC RECORDS. BARGHAUSEN CONSULTING ENGINEERS, INC. ASSUMES NO LIABILITY FOR THE ACCURACY OF PUBLIC RECORDS OR RECORDS OF OTHERS. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, LLC TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

4. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO REVIEW ALL OF THE DRAWINGS AND SPECIFICATIONS ASSOCIATED WITH THE PROJECT WORK SCOPE PRIOR TO THE INITIATION OF CONSTRUCTION. SHOULD THE CONTRACTOR FIND A CONFLICT WITH THE DOCUMENTS RELATIVE TO THE SPECIFICATIONS OR THE RELATIVE CODES, IT IS THE CONTRACTOR'S RESPONSIBILITY TO NOTIFY THE PROJECT ENGINEER OF RECORD IN WRITING PRIOR TO THE START OF CONSTRUCTION. FAILURE BY THE CONTRACTOR TO NOTIFY THE PROJECT ENGINEER SHALL CONSTITUTE ACCEPTANCE OF FULL RESPONSIBILITY BY THE CONTRACTOR TO COMPLETE THE SCOPE OF WORK AS DEFINED BY THE DRAWINGS AND IN FULL COMPLIANCE WITH LOCAL REGULATIONS AND CODES.

5. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO NOTIFY THE APPROPRIATE UTILITIES INVOLVED PRIOR TO CONSTRUCTION.

6. INSPECTION OF SITE WORK WILL BE ACCOMPLISHED BY A REPRESENTATIVE OF THE GOVERNING JURISDICTION. INSPECTION OF PRIVATE FACILITIES WILL BE ACCOMPLISHED BY A REPRESENTATIVE OF THE OWNER. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO NOTIFY THE INSPECTOR 24 HOURS IN ADVANCE OF BACKFILLING ALL CONSTRUCTION.

7. PRIOR TO ANY CONSTRUCTION OR DEVELOPMENT ACTIVITY THE CONTRACTOR SHALL CONTACT THE AGENCY AND/OR UTILITY INSPECTION PERSONNEL AND ARRANGE ANY REQUIRED PRE–CONSTRUCTION MEETING(S). CONTRACTOR SHALL PROVIDE ONE WEEK MINIMUM ADVANCE NOTIFICATION TO OWNER, FIELD ENGINEER AND ENGINEER OF PRE–CONSTRUCTION MEETINGS.

8. THE CONTRACTOR IS RESPONSIBLE FOR WORKER AND SITE SAFETY AND SHALL COMPLY WITH THE LATEST OSHA STANDARDS AND REGULATIONS, OR ANY OTHER AGENCY HAVING JURISDICTION FOR EXCAVATION AND TRENCHING PROCEDURES. THE CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE "MEANS AND METHODS" REQUIRED TO MEET THE INTENT AND PERFORMANCE CRITERIA OF OSHA, AS WELL AS ANY OTHER ENTITY THAT HAS JURISDICTION FOR EXCAVATION AND/OR TRENCHING PROCEDURES.

9. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ADEQUATE SAFEGUARDS, SAFETY DEVICES, PROTECTIVE EQUIPMENT, FLAGGERS, AND ANY OTHER NEEDED ACTIONS TO PROTECT THE LIFE, HEALTH, AND SAFETY OF THE PUBLIC, AND TO PROTECT PROPERTY IN CONNECTION WITH THE PERFORMANCE OF WORK COVERED BY THE CONTRACTOR. ANY WORK WITHIN THE TRAVELED RIGHT–OF–WAY THAT MAY INTERRUPT NORMAL TRAFFIC FLOW SHALL REQUIRE AT LEAST ONE FLAGGER FOR EACH LANE OF TRAFFIC AFFECTED.

10. PROTECTIVE MEASURES SHALL BE TAKEN BY THE CONTRACTOR TO PROTECT ALL ADJACENT PUBLIC AND PRIVATE PROPERTIES AT ALL TIMES DURING CONSTRUCTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTION OF ALL EXISTING UTILITY SERVICES THAT ARE TO REMAIN OPERATIONAL WITHIN THE CONSTRUCTION AREA WHETHER SHOWN OR NOT SHOWN ON THE PLANS.

11. TWO (2) COPIES OF THESE APPROVED PLANS MUST BE ON THE JOB SITE WHENEVER CONSTRUCTION IS IN PROGRESS. ONE (1) SET WITH RECORDS OF AS–BUILT INFORMATION SHALL BE SUBMITTED TO BARGHAUSEN CONSULTING ENGINEERS, LLC AT COMPLETION OF PROJECT.

12. CONTRACTOR SHALL OBTAIN SERVICES OF A LICENSED LAND SURVEYOR TO STAKE HORIZONTAL CONTROL FOR ALL NEW IMPROVEMENTS. STAKING CONTROL SHALL BE TAKEN FROM ELECTRONIC PLAN FILES PROVIDED BY BARGHAUSEN CONSULTING ENGINEERS, LLC.

13. CONTRACTOR SHALL REQUEST FROM BARGHAUSEN CONSULTING ENGINEERS, LLC. PRIOR TO ANY CONSTRUCTION STAKING OR CONSTRUCTION WORK. A FORMAL CONSTRUCTION RELEASE PLAN SET OR SPECIFIC RELEASE IN WRITING. THE APPROVED AGENCY PERMIT DRAWINGS WILL NOT BE CONSIDERED CONSTRUCTION RELEASE PLANS BY BARGHAUSEN CONSULTING ENGINEERS, LLC. UNLESS BARGHAUSEN CONSULTING ENGINEERS, LLC HAS GIVEN A FORMAL WRITTEN RELEASE OR ISSUED A CONSTRUCTION RELEASE PLAN SET.

SHEET INDEX

C1	OF 48	COVER SHEET
C2	OF 48	EXISTING CONDITIONS – LEGAL DESCRIPTIONS
C3	OF 48	EXISTING CONDITIONS – LEGAL DESCRIPTIONS
C4	OF 48	EXISTING CONDITIONS
C5	OF 48	EXISTING CONDITIONS
C6	OF 48	EXISTING CONDITIONS
C7	OF 48	PRELIMINARY STORM DRAINAGE OVERALL PLAN
C8	OF 48	PRELIMINARY GRADING AND DRAINAGE PLAN
C9	OF 48	PRELIMINARY GRADING AND DRAINAGE PLAN
C10	OF 48	PRELIMINARY GRADING AND DRAINAGE PLAN
C11	OF 48	PRELIMINARY GRADING AND DRAINAGE PLAN
C12	OF 48	PRELIMINARY DRAINAGE OUTLET PLAN
C13	OF 48	PRELIMINARY DRAINAGE OUTLET PLAN
C14	OF 48	PRELIMINARY DETENTION VAULT PLAN – NORTH
C15	OF 48	PRELIMINARY DETENTION VAULT PLAN – SOUTH
C16	OF 48	PRELIMINARY WATER AND SEWER OVERALL PLAN
C17	OF 48	PRELIMINARY WATER AND SEWER PLAN
C18	OF 48	PRELIMINARY WATER AND SEWER PLAN
C19	OF 48	PRELIMINARY WATER AND SEWER PLAN
C20	OF 48	PRELIMINARY ROAD IMPROVEMENT FREEMAN AND LEVEE INTERSECTION
C21	OF 48	PRELIMINARY ROAD IMPROVEMENTS STA 50+00 TO 55+00
C22	OF 48	PRELIMINARY ROAD IMPROVEMENTS STA 55+00 TO 60+00
C23	OF 48	PRELIMINARY ROAD IMPROVEMENTS STA 60+00 TO 65+00
C24	OF 48	PRELIMINARY ROAD IMPROVEMENTS STA 65+00 TO 70+00
C25	OF 48	PRELIMINARY ROAD IMPROVEMENTS STA 70+00 TO 75+00
C26	OF 48	PRELIMINARY ROAD IMPROVEMENTS STA 75+00 TO 77+20
C27	OF 48	PRELIMINARY ROAD IMPROVEMENTS 22ND AVE NW
C28	OF 48	PRELIMINARY ROAD IMPROVEMENTS 48TH ST STA 300+00 TO 301+00
C29	OF 48	PRELIMINARY ROAD IMPROVEMENTS 48TH ST STA 301+00 TO 307+00
C30	OF 48	PRELIMINARY ROAD IMPROVEMENTS 48TH ST STA 307+00 TO 313+00
C31	OF 48	PRELIMINARY ROAD IMPROVEMENTS 48TH ST STA 313+00 TO 319+00
C32	OF 48	PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN
C33	OF 48	PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN STA 50+00 TO 60+00
C34	OF 48	PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN STA 60+00 TO 70+00
C35	OF 48	PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN STA 70+00 TO 77+20
C36	OF 48	PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN 22ND AVE NW
C37	OF 48	PRELIMINARY CONSTRUCTION NOTES
C38	OF 48	PRELIMINARY CONSTRUCTION DETAILS
C39	OF 48	PRELIMINARY CONSTRUCTION DETAILS
C40	OF 48	PRELIMINARY CONSTRUCTION DETAILS
C41	OF 48	PRELIMINARY CONSTRUCTION DETAILS
C42	OF 48	PRELIMINARY CONSTRUCTION DETAILS
C43	OF 48	PRELIMINARY STORM PUMP DETAILS
C44	OF 48	PRELIMINARY TRUCK TURN EXHIBIT NORTH ACCESS
C45	OF 48	PRELIMINARY TRUCK TURN EXHIBIT SOUTH ACCESS
C46	OF 48	PRELIMINARY TRUCK TURN EXHIBIT FREEMAN + LEVEE
C47	OF 48	PRELIMINARY SITE CIRCULATION EXHIBIT – NORTH
C48	OF 48	PRELIMINARY SITE CIRCULATION EXHIBIT – SOUTH

DEVELOPER/OWNER
VECTOR DEVELOPMENT COMPANY
11411 NE 124TH WAY SUITE 190
KIRKLAND, WA 98034
PH: (425) 968–5115
CONTACT: TYLER LITZENBERGER
EMAIL: TLITZ@VECTORRECORP.COM

SURVEYOR
LANKTREE LAND SURVEYING, INC.
25510 74TH AVENUE SOUTH
KENT WA, 98032
PH: (253) 653–6423
CONTACT: TREVOR LANKTREE, P.L.S.
EMAIL: TLANKTREE@LANKTREELAND.COM

ENVIRONMENTAL
ANCHOR QEA, LLC.
1201 3RD AVE #2600
SEATTLE WA, 98101
PH: (206) 287–9130
CONTACT: CALVIN DOUGLAS

GEOTECHNICAL
TERRA ASSOCIATES
12220 113TH AVE NE SUITE 130
BELLEVUE, WA 98034
PH: (425) 821–7777
CONTACT: CAROLYN S. DECKER, P.E.
EMAIL: CDECKER@TERRA–ASSOCIATES.COM

ENGINEER
BARGHAUSEN CONSULTING ENGINEERS, LLC
18215 72ND AVE S
KENT WA, 98032
PH: (425) 251–6222
CONTACT: JASON MCARDEL, P.E.
EMAIL: JMCARDEL@BARGHAUSEN.COM

ARCHITECT
SYNTHESIS, PLLC
12503 NE BELL–RED ROAD, SUITE 100
BELLEVUE, WA 98005
PH: (425) 646–1818
CONTACT: LISA MORRELL EHIL
EMAIL: LISA.EHIL@SYNTHESISPLLC.COM

TRAFFIC ENGINEER
KIMLEY HORN
22722 29TH DRIVE SE, SUITE 100
BOTHELL, WA 98021
PH: (425) 339–8266
CONTACT: MATT PALMER
EMAIL: PALMER@KIMLEY–HORN.COM

CULTURAL RESOURCES
ENVIRONMENTAL SCIENCE ASSOCIATES (ESA)
5309 SHILSHOLE AVENUE, NW SUITE 200
SEATTLE, WA 98107
PH: (206) 789–9658
CONTACT: TOM OSTRANDER, ARCHAEOLOGIST

LOT COVERAGE SUMMARY

BUILDINGS:	505,436 S.F. = 11.60 AC	(48.23%)
ASPHALT/CONCRETE:	338,036 S.F. = 7.76 AC	(32.26%)
LANDSCAPE/UNDISTURBED:	204,146 S.F. = 4.69 AC	(19.51%)
TOTAL	1,047,618 S.F.= 24.05 AC	(100%)

MONUMENT PROTECTION NOTE:

CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR OBTAINING PERMITS FROM THE WASHINGTON STATE DEPARTMENT OF NATURAL RESOURCES FOR REMOVING AND REPLACING ALL SURVEY MONUMENTATION THAT MAY BE AFFECTED BY CONSTRUCTION ACTIVITY, PURSUANT TO WAC 332–120. APPLICATIONS MUST BE COMPLETED BY A REGISTERED LAND SURVEYOR. APPLICATIONS FOR PERMITS TO REMOVE MONUMENTS MAY BE OBTAINED FROM THE WASHINGTON STATE DEPARTMENT OF NATURAL RESOURCES, OR BY CONTACTING THEIR OFFICE BY TELEPHONE AT (206) 902–1190.

WASHINGTON STATE DEPARTMENT OF NATURAL RESOURCES
PUBLIC LAND SURVEY OFFICE
1111 WASHINGTON STREET S.E.
P.O. BOX 47060
OLYMPIA, WASHINGTON 98504–7060

UPON COMPLETION OF CONSTRUCTION, ALL MONUMENTS DISPLACED, REMOVED, OR DESTROY

EXISTING CONDITIONS - LEGAL DESCRIPTIONS

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

LEGAL DESCRIPTIONS:

PARCEL A
WESTBY (APN 042020-5017) FIRSTAM ORDER 4269-3710994, MARCH 22, 2021
LOT 2, PIERCE COUNTY SHORT PLAT, ACCORDING TO PLAT RECORDED MARCH 23, 1994 UNDER RECORDING NO. 9403231137, IN PIERCE COUNTY, WASHINGTON.

SITUATE IN THE COUNTY OF PIERCE, STATE OF WASHINGTON

SPECIAL EXCEPTIONS: [FIRST AMERICAN TITLE INSURANCE COMPANY COMMITMENT NO. 4269-3710994]
ITEM A1) ANY DEFECT, LIEN, ENCUMBRANCE, ADVERSE CLAIM, OR OTHER MATTER THAT APPEARS FOR THE FIRST TIME IN THE PUBLIC RECORDS OR IS CREATED, ATTACHES, OR IS DISCLOSED BETWEEN THE COMMITMENT DATE AND THE DATE ON WHICH ALL OF THE SCHEDULE B, PART I–REQUIREMENTS ARE MET. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM A2) TAXES OR ASSESSMENTS **(NON SURVEY RELATED ITEMS)**

ITEM A3) ANY FACTS, RIGHTS, INTERESTS, OR CLAIMS WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS BUT WHICH COULD BE ASCERTAINED BY AN INSPECTION OF THE LAND OR BY MAKING INQUIRY OF PERSONS IN POSSESSION THEREOF. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM A4) EASEMENTS, CLAIMS OF EASEMENT OR ENCUMBRANCES WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM A5) DISCREPANCIES, CONFLICTS IN BOUNDARY LINES, SHORTAGE IN AREA, ENCROACHMENTS, OR ANY OTHER FACTS WHICH A CORRECT SURVEY WOULD DISCLOSE, AND WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM A6) REFERS TO MINING CLAIMS; **(NON SURVEY RELATED ITEM)**

ITEM A7) ANY LIEN, OR RIGHT TO A LIEN, FOR SERVICES, LABOR OR MATERIALS OR MEDICAL ASSISTANCE HERETOFORE OR HEREAFTER FURNISHED, IMPOSED BY LAW AND NOT SHOWN BY THE PUBLIC RECORDS. **(NON SURVEY RELATED ITEM)**

ITEM A8) ANY SERVICE, INSTALLATION, CONNECTION, MAINTENANCE, CONSTRUCTION, TAP OR REIMBURSEMENT CHARGES/COSTS FOR SEWER, WATER, GARBAGE OR ELECTRICITY. **(NON SURVEY RELATED ITEM)**

ITEMS A9–A10) TAX RELATED **(NON SURVEY RELATED ITEMS)**

ITEM A11) EVIDENCE OF THE AUTHORITY OF THE INDIVIDUAL(S) TO EXECUTE THE FORTHCOMING DOCUMENT FOR VECTOR WASHINGTON LLC, COPIES OF THE CURRENT OPERATING AGREEMENT SHOULD BE SUBMITTED PRIOR TO CLOSING. **(NON SURVEY RELATED ITEM)**

ITEM A12) TERMS, PROVISIONS, CONDITIONS OF THE TRUST AGREEMENT OF LYLE A. WESTBY, JR. AND LAVON D. WESTBY REVOCABLE LIVING TRUST DATED JULY 23, 1996, AND ANY SUBSEQUENT MODIFICATIONS, A COPY OF WHICH SHOULD BE SUBMITTED TO THIS OFFICE FOR INSPECTION. **(DOCUMENT NOT PROVIDED)**

ITEM A13) EASEMENT, INCLUDING TERMS AND PROVISIONS CONTAINED THEREIN:

RECORDING INFORMATION: 1295136
IN FAVOR OF: PUGET SOUND ENERGY, INC., A WASHINGTON CORPORATION
FOR: ELECTRIC TRANSMISSION AND/OR DISTRIBUTION SYSTEM **(AS SHOWN HEREON)**

ITEM A14) ANY AND ALL OFFERS OF DEDICATION, CONDITIONS, RESTRICTIONS, EASEMENTS, BOUNDARY DISCREPANCIES OR ENCROACHMENTS, NOTES AND/OR PROVISIONS SHOWN OR DISCLOSED BY SHORT PLAT RECORDED UNDER RECORDING NUMBER 9403231137. **(AS SHOWN HEREON)**

ITEM A15) EASEMENT, INCLUDING TERMS AND PROVISIONS CONTAINED THEREIN:
RECORDED: APRIL 12, 1994
RECORDING INFORMATION: 9404120568
IN FAVOR OF: PUGET SOUND ENERGY, INC., A WASHINGTON CORPORATION
FOR: ELECTRIC TRANSMISSION AND/OR DISTRIBUTION SYSTEM **(AS SHOWN HEREON)**

PARCEL B
SESSLER (APN 042017-4075) FIRSTAM ORDER 4269-3711001, MARCH 15, 2021
THAT PORTION OF THE SOUTHWEST QUARTER OF THE SOUTHEAST QUARTER OF SECTION 17, TOWNSHIP 20 NORTH, RANGE 4 EAST, OF THE WILLAMETTE MERIDIAN, LYING SOUTH OF THE EASTERLY LINE OF THE PUGET SOUND ELECTRIC RIGHT-OF-WAY;

EXCEPT THE NORTHERLY 208 FEET;

ALSO EXCEPT THAT PORTION LYING WITHIN ROADS;

SPECIAL EXCEPTIONS: [FIRST AMERICAN TITLE INSURANCE COMPANY COMMITMENT NO. 4269-3710994]
ITEM B1) ANY DEFECT, LIEN, ENCUMBRANCE, ADVERSE CLAIM, OR OTHER MATTER THAT APPEARS FOR THE FIRST TIME IN THE PUBLIC RECORDS OR IS CREATED, ATTACHES, OR IS DISCLOSED BETWEEN THE COMMITMENT DATE AND THE DATE ON WHICH ALL OF THE SCHEDULE B, PART I–REQUIREMENTS ARE MET. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM B2) TAXES OR ASSESSMENTS **(NON SURVEY RELATED ITEM)**

ITEM B3) ANY FACTS, RIGHTS, INTERESTS, OR CLAIMS WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS BUT WHICH COULD BE ASCERTAINED BY AN INSPECTION OF THE LAND OR BY MAKING INQUIRY OF PERSONS IN POSSESSION THEREOF. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM B4) EASEMENTS, CLAIMS OF EASEMENT OR ENCUMBRANCES WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM B5) DISCREPANCIES, CONFLICTS IN BOUNDARY LINES, SHORTAGE IN AREA, ENCROACHMENTS, OR ANY OTHER FACTS WHICH A CORRECT SURVEY WOULD DISCLOSE, AND WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM B6) (A) UNPATENTED MINING CLAIMS; (B) RESERVATIONS OR EXCEPTIONS IN PATENTS OR IN ACTS AUTHORIZING THE ISSUANCE THEREOF; (C) WATER RIGHTS, CLAIMS OR TITLE TO WATER; WHETHER OR NOT THE MATTERS EXCEPTED UNDER (A), (B) OR (C) ARE SHOWN BY THE PUBLIC RECORDS; (D) INDIAN TRIBAL CODES OR REGULATIONS, INDIAN TREATY OR ABORIGINAL RIGHTS, INCLUDING EASEMENTS OR EQUITABLE SERVITUDES. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM B7) ANY LIEN, OR RIGHT TO A LIEN, FOR SERVICES, LABOR OR MATERIALS OR MEDICAL ASSISTANCE HERETOFORE OR HEREAFTER FURNISHED, IMPOSED BY LAW AND NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM B8) ANY SERVICE, INSTALLATION, CONNECTION, MAINTENANCE, CONSTRUCTION, TAP OR REIMBURSEMENT CHARGES/COSTS FOR SEWER, WATER, GARBAGE OR ELECTRICITY. **(NON SURVEY RELATED ITEM)**

ITEMS B9–B10) TAX RELATED **(NON SURVEY RELATED ITEM)**

ITEM 11) DEED OF TRUST AND THE TERMS AND CONDITIONS THEREOF.
GRANTOR/TRUSTOR: JON E. SESSLER AND MARIA J. SESSLER, HUSBAND AND WIFE
GRANTEE/BENEFICIARY: SESSLER, INC., A WASHINGTON CORPORATION
TRUSTEE: CHICAGO TITLE INSURANCE COMPANY
DATED: JANUARY 09, 2006
RECORDED: FEBRUARY 05, 2008
RECORDING INFORMATION: 200802050818

ITEM 12) EVIDENCE OF THE AUTHORITY OF THE INDIVIDUAL(S) TO EXECUTE THE FORTHCOMING DOCUMENT FOR VECTOR WASHINGTON LLC, COPIES OF THE CURRENT OPERATING AGREEMENT SHOULD BE SUBMITTED PRIOR TO CLOSING. **(NON SURVEY RELATED ITEM)**

PARCEL C
KEATON (APN 042017-4075) FIRSTAM ORDER 4269-3358130, NOVEMBER 12, 2019
THE SOUTH 75 FEET OF THE NORTHWEST QUARTER OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SECTION 20, TOWNSHIP 20 NORTH, RANGE 4 EAST OF THE WILLAMETTE MERIDIAN, IN PIERCE COUNTY, WASHINGTON.
(DOES NOT EXCEPT OUT FREEMAN ROAD)

SPECIAL EXCEPTIONS: [FIRST AMERICAN TITLE INSURANCE COMPANY COMMITMENT NO. 4269-3358130]
ITEM C1) ANY DEFECT, LIEN, ENCUMBRANCE, ADVERSE CLAIM, OR OTHER MATTER THAT APPEARS FOR THE FIRST TIME IN THE PUBLIC RECORDS OR IS CREATED, ATTACHES, OR IS DISCLOSED BETWEEN THE COMMITMENT DATE AND THE DATE ON WHICH ALL OF THE SCHEDULE B, PART I–REQUIREMENTS ARE MET. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM C2) TAXES OR ASSESSMENTS WHICH ARE NOT SHOWN AS EXISTING LIENS BY THE RECORDS OF ANY TAXING AUTHORITY THAT LEVIES TAXES OR ASSESSMENTS ON REAL PROPERTY OR BY THE PUBLIC RECORDS. **(NON SURVEY RELATED ITEM)**

ITEM C3) ANY FACTS, RIGHTS, INTERESTS, OR CLAIMS WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS BUT WHICH COULD BE ASCERTAINED BY AN INSPECTION OF THE LAND OR BY MAKING INQUIRY OF PERSONS IN POSSESSION THEREOF. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM C4) EASEMENTS, CLAIMS OF EASEMENT OR ENCUMBRANCES WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM C5) DISCREPANCIES, CONFLICTS IN BOUNDARY LINES, SHORTAGE IN AREA, ENCROACHMENTS, OR ANY OTHER FACTS WHICH A CORRECT SURVEY WOULD DISCLOSE, AND WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM C6) (A) UNPATENTED MINING CLAIMS; (B) RESERVATIONS OR EXCEPTIONS IN PATENTS OR IN ACTS AUTHORIZING THE ISSUANCE THEREOF; (C) WATER RIGHTS, CLAIMS OR TITLE TO WATER; WHETHER OR NOT THE MATTERS EXCEPTED UNDER (A), (B) OR (C) ARE SHOWN BY THE PUBLIC RECORDS; (D) INDIAN TRIBAL CODES OR REGULATIONS, INDIAN TREATY OR ABORIGINAL RIGHTS, INCLUDING EASEMENTS OR EQUITABLE SERVITUDES. **(NON SURVEY RELATED ITEM)**

ITEM C7) ANY LIEN, OR RIGHT TO A LIEN, FOR SERVICES, LABOR OR MATERIALS OR MEDICAL ASSISTANCE HERETOFORE OR HEREAFTER FURNISHED, IMPOSED BY LAW AND NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM C8) ANY SERVICE, INSTALLATION, CONNECTION, MAINTENANCE, CONSTRUCTION, TAP OR REIMBURSEMENT CHARGES/COSTS FOR SEWER, WATER, GARBAGE OR ELECTRICITY. **(NON SURVEY RELATED ITEM)**

ITEM C9) LIEN OF THE REAL ESTATE EXCISE SALES TAX AND SURCHARGE UPON ANY SALE OF SAID PREMISES, IF UNPAID. AS OF THE DATE HEREIN, THE EXCISE TAX RATE FOR UNINCORPORATED PIERCE COUNTY IS AT 1.78 %. LEVY/AREA CODE: 205 **(NON SURVEY RELATED ITEM)**

ITEM C10) DEED OF TRUST AND THE TERMS AND CONDITIONS THEREOF.
GRANTOR/TRUSTOR: SAMUEL S. KEATON, A SINGLE MAN
GRANTEE/BENEFICIARY: BANK OF AMERICA, N.A.
TRUSTEE: RECONTRUST COMPANY, N.A.
DATED: FEBRUARY 16, 2017
RECORDED: FEBRUARY 17, 2017
RECORDING INFORMATION: 201702170332

ITEM C11) EVIDENCE OF THE AUTHORITY OF THE INDIVIDUAL(S) TO EXECUTE THE FORTHCOMING DOCUMENT FOR VECTOR WASHINGTON LLC, COPIES OF THE CURRENT OPERATING AGREEMENT SHOULD BE SUBMITTED PRIOR TO CLOSING. **(NON SURVEY RELATED ITEM)**

ITEM C12) THE LAND DESCRIBED IN THIS COMMITMENT APPEARS TO BE RESIDENTIAL IN NATURE AND MAY BE SUBJECT TO THE PROVISIONS OF R.C.W. 6.13.010, ET SEQ. (HOMESTEAD STATUTE) IF THE LAND IS OCCUPIED AS A PRIMARY RESIDENCE. IF THE LAND IS OCCUPIED AS A PRIMARY RESIDENCE, R.C.W. 6.13.060 REQUIRES THAT ALL DOCUMENTS CONVEYING OR ENCUMBERING THE LAND MUST BE EXECUTED BY EACH SPOUSE OR DOMESTIC PARTNER, INDIVIDUALLY. ALTERNATIVELY, THE COMPANY WILL ACCEPT A DEED IDENTIFYING THE NON-VESTED SPOUSE OCCUPYING THE PROPERTY AS THE GRANTOR AND THE VESTED SPOUSE AS THE GRANTEE. IN THE EVENT THAT THE COMPANY RECEIVES DOCUMENTS TO INSURE THAT ARE NOT EXECUTED AS REQUIRED, THE COMPANY MAY BE UNABLE TO RECORD OR TO INSURE THE TRANSACTION. PLEASE CONTACT YOUR TITLE OFFICER IF YOU HAVE ANY QUESTIONS. **(NON SURVEY RELATED ITEM)**

ITEM C13) QUESTIONS OF SURVEY, RIGHT OF PERSON(S) IN POSSESSION, MATERIAL OR LABOR LIENS, WORKMEN'S COMPENSATION LIENS, ANY IMPAIRMENT OF EXISTING IMPROVEMENTS BY REASON OF EASEMENTS NOTED HEREIN, AND ANY BREACH OF THE RESTRICTIONS NOTED HEREIN, DISPOSITION OF WHICH WILL BE DETERMINED BY A ALTA/NSPS LAND TITLE SURVEY AND AN ALTA LIEN AFFIDAVIT. **(SEE SURVEY FOR EXISTING CONDITIONS)**

PARCEL D
GALLOWAY-1 (APN 042020-1039) FIRSTAM ORDER 4266-3319199, SEPTEMBER 6, 2019
BEGINNING AT A POINT 15 FEET EAST OF THE NORTHWEST CORNER OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SECTION 20, TOWNSHIP 20 NORTH, RANGE 4 EAST OF THE W.M., IN PIERCE COUNTY, WASHINGTON;
THENCE EAST 330 FEET;
THENCE SOUTH 272.06 FEET;
THENCE WEST 330 FEET;
THENCE NORTH 272.06 FEET TO THE POINT OF BEGINNING;

EXCEPT THE SOUTH 100 FEET OF THE WEST 160 FEET THEREOF.

PARCEL E
GALLOWAY-2 (APN 042020-1066) FIRSTAM ORDER 4266-3319199, SEPTEMBER 6, 2019
THE SOUTH 100 FEET OF THE WEST 160 FEET OF THE FOLLOWING DESCRIBED PROPERTY:
BEGINNING AT A POINT 15 FEET EAST OF THE NORTHWEST CORNER OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SECTION 20, TOWNSHIP 20 NORTH, RANGE 4 EAST OF THE W.M., IN PIERCE COUNTY, WASHINGTON;
THENCE EAST 330 FEET;
THENCE SOUTH 272.06 FEET;
THENCE WEST 330 FEET;
THENCE NORTH 272.06 FEET TO THE POINT OF BEGINNING.

SPECIAL EXCEPTIONS: [FIRST AMERICAN TITLE INSURANCE COMPANY COMMITMENT NO. 4266-3319199]
ITEM DE1) ANY DEFECT, LIEN, ENCUMBRANCE, ADVERSE CLAIM, OR OTHER MATTER THAT APPEARS FOR THE FIRST TIME IN THE PUBLIC RECORDS OR IS CREATED, ATTACHES, OR IS DISCLOSED BETWEEN THE COMMITMENT DATE AND THE DATE ON WHICH ALL OF THE SCHEDULE B, PART I–REQUIREMENTS ARE MET. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM DE2) TAXES OR ASSESSMENTS WHICH ARE NOT SHOWN AS EXISTING LIENS BY THE RECORDS OF ANY TAXING AUTHORITY THAT LEVIES TAXES OR ASSESSMENTS ON REAL PROPERTY OR BY THE PUBLIC RECORDS. **(NON SURVEY RELATED ITEM)**

ITEM DE3) ANY FACTS, RIGHTS, INTERESTS, OR CLAIMS WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS BUT WHICH COULD BE ASCERTAINED BY AN INSPECTION OF THE LAND OR BY MAKING INQUIRY OF PERSONS IN POSSESSION THEREOF. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM DE4) EASEMENTS, CLAIMS OF EASEMENT OR ENCUMBRANCES WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM DE5) DISCREPANCIES, CONFLICTS IN BOUNDARY LINES, SHORTAGE IN AREA, ENCROACHMENTS, OR ANY OTHER FACTS WHICH A CORRECT SURVEY WOULD DISCLOSE, AND WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM DE6) (A) UNPATENTED MINING CLAIMS; (B) RESERVATIONS OR EXCEPTIONS IN PATENTS OR IN ACTS AUTHORIZING THE ISSUANCE THEREOF; (C) WATER RIGHTS, CLAIMS OR TITLE TO WATER; WHETHER OR NOT THE MATTERS EXCEPTED UNDER (A), (B) OR (C) ARE SHOWN BY THE PUBLIC RECORDS; (D) INDIAN TRIBAL CODES OR REGULATIONS, INDIAN TREATY OR ABORIGINAL RIGHTS, INCLUDING EASEMENTS OR EQUITABLE SERVITUDES. **(NON SURVEY RELATED ITEM)**

ITEM DE7) ANY LIEN, OR RIGHT TO A LIEN, FOR SERVICES, LABOR OR MATERIALS OR MEDICAL ASSISTANCE HERETOFORE OR HEREAFTER FURNISHED, IMPOSED BY LAW AND NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM DE8) ANY SERVICE, INSTALLATION, CONNECTION, MAINTENANCE, CONSTRUCTION, TAP OR REIMBURSEMENT CHARGES/COSTS FOR SEWER, WATER, GARBAGE OR ELECTRICITY. **(NON SURVEY RELATED ITEM)**

ITEM DE9) LIEN OF THE REAL ESTATE EXCISE SALES TAX AND SURCHARGE UPON ANY SALE OF SAID PREMISES, IF UNPAID. AS OF THE DATE HEREIN, THE EXCISE TAX RATE FOR UNINCORPORATED PIERCE COUNTY IS AT 1.78 %. LEVY/AREA CODE: 205 **(NON SURVEY RELATED ITEM)**

ITEMS DE10–DE11) GENERAL TAXES **(NON SURVEY RELATED ITEMS)**

ITEM DE12) DEED OF TRUST AND THE TERMS AND CONDITIONS THEREOF.
GRANTOR/TRUSTOR: MIKE H. GALLOWAY AND GALE L. GALLOWAY, HUSBAND AND WIFE
GRANTEE/BENEFICIARY: MORTGAGE ELECTRONIC REGISTRATION SYSTEMS, INC., "MERS" SOLELY AS A NOMINEE FOR PRIMELENDING, A PLAINSCAPITAL COMPANY, ITS SUCCESSORS AND ASSIGNS
TRUSTEE: PACIFIC NORTHWEST TITLE AND ESCROW
DATED: MARCH 14, 2011
RECORDED: MARCH 21, 2011
RECORDING INFORMATION: 201103210359

ITEM DE13) EVIDENCE OF THE AUTHORITY OF THE INDIVIDUAL(S) TO EXECUTE THE FORTHCOMING DOCUMENT FOR VECTOR WASHINGTON LLC, COPIES OF THE CURRENT OPERATING AGREEMENT SHOULD BE SUBMITTED PRIOR TO CLOSING. **(NON SURVEY RELATED ITEM)**

ITEM DE14) QUESTIONS OF SURVEY, RIGHT OF PERSON(S) IN POSSESSION, MATERIAL OR LABOR LIENS, WORKMEN'S COMPENSATION LIENS, ANY IMPAIRMENT OF EXISTING IMPROVEMENTS BY REASON OF EASEMENTS NOTED HEREIN, AND ANY BREACH OF THE RESTRICTIONS NOTED HEREIN, DISPOSITION OF WHICH WILL BE DETERMINED BY A ALTA/NSPS LAND TITLE SURVEY AND AN ALTA LIEN AFFIDAVIT. **(SEE SURVEY FOR EXISTING CONDITIONS)**

PARCEL F
SHADLE (APN 042020-1042) FIRSTAM ORDER 4266-3346938, OCTOBER 22, 2019
BEGINNING 601 FEET SOUTH AND 181.79 FEET EAST OF THE NORTHWEST CORNER OF THE NORTHWEST QUARTER OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SECTION 20, TOWNSHIP 20 NORTH, RANGE 4 EAST OF THE WILLAMETTE MERIDIAN;

THENCE NORTH 172.0 FEET;
THENCE EAST 330 FEET;
THENCE SOUTH 172 FEET;
THENCE WEST 330 FEET TO POINT OF BEGINNING, IN PIERCE COUNTY, WASHINGTON.

SPECIAL EXCEPTIONS: [FIRST AMERICAN TITLE INSURANCE COMPANY COMMITMENT NO. 4266-3346938]
ITEM F1) ANY DEFECT, LIEN, ENCUMBRANCE, ADVERSE CLAIM, OR OTHER MATTER THAT APPEARS FOR THE FIRST TIME IN THE PUBLIC RECORDS OR IS CREATED, ATTACHES, OR IS DISCLOSED BETWEEN THE COMMITMENT DATE AND THE DATE ON WHICH ALL OF THE SCHEDULE B, PART I–REQUIREMENTS ARE MET. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM F2) TAXES OR ASSESSMENTS WHICH ARE NOT SHOWN AS EXISTING LIENS BY THE RECORDS OF ANY TAXING AUTHORITY THAT LEVIES TAXES OR ASSESSMENTS ON REAL PROPERTY OR BY THE PUBLIC RECORDS. **(NON SURVEY RELATED ITEM)**

ITEM F3) ANY FACTS, RIGHTS, INTERESTS, OR CLAIMS WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS BUT WHICH COULD BE ASCERTAINED BY AN INSPECTION OF THE LAND OR BY MAKING INQUIRY OF PERSONS IN POSSESSION THEREOF. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM F4) EASEMENTS, CLAIMS OF EASEMENT OR ENCUMBRANCES WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM F5) DISCREPANCIES, CONFLICTS IN BOUNDARY LINES, SHORTAGE IN AREA, ENCROACHMENTS, OR ANY OTHER FACTS WHICH A CORRECT SURVEY WOULD DISCLOSE, AND WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM F6) (A) UNPATENTED MINING CLAIMS; (B) RESERVATIONS OR EXCEPTIONS IN PATENTS OR IN ACTS AUTHORIZING THE ISSUANCE THEREOF; (C) WATER RIGHTS, CLAIMS OR TITLE TO WATER; WHETHER OR NOT THE MATTERS EXCEPTED UNDER (A), (B) OR (C) ARE SHOWN BY THE PUBLIC RECORDS; (D) INDIAN TRIBAL CODES OR REGULATIONS, INDIAN TREATY OR ABORIGINAL RIGHTS, INCLUDING EASEMENTS OR EQUITABLE SERVITUDES. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM F7) ANY LIEN, OR RIGHT TO A LIEN, FOR SERVICES, LABOR OR MATERIALS OR MEDICAL ASSISTANCE HERETOFORE OR HEREAFTER FURNISHED, IMPOSED BY LAW AND NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM F8) ANY SERVICE, INSTALLATION, CONNECTION, MAINTENANCE, CONSTRUCTION, TAP OR REIMBURSEMENT CHARGES/COSTS FOR SEWER, WATER, GARBAGE OR ELECTRICITY **(NON SURVEY RELATED ITEM)**

ITEM F9) LIEN OF THE REAL ESTATE EXCISE SALES TAX AND SURCHARGE UPON ANY SALE OF SAID PREMISES, IF UNPAID. AS OF THE DATE HEREIN, THE EXCISE TAX RATE FOR UNINCORPORATED PIERCE COUNTY IS AT 1.78 %. LEVY/AREA CODE: 205 **(NON SURVEY RELATED ITEM)**

ITEM F10) DEED OF TRUST AND THE TERMS AND CONDITIONS THEREOF.
GRANTOR/TRUSTOR: DANNY A SHADLE AND WENDY K SHADLE HUSBAND AND WIFE
GRANTEE/BENEFICIARY: MORTGAGE ELECTRONIC REGISTRATION SYSTEMS, INC., "MERS" SOLELY AS A NOMINEE FOR FIELDSTONE MORTGAGE COMPANY, ITS SUCCESSORS AND ASSIGNS
TRUSTEE: PACIFIC NORTHWEST TITLE COMPANY OF WASHINGTON, INC.
DATED: JUNE 23, 2007
RECORDED: JUNE 28, 2007
RECORDING INFORMATION: 200706280546
MODIFICATION AND/OR AMENDMENT BY INSTRUMENT:
RECORDED: AUGUST 08, 2013
RECORDING INFORMATION: 201308080340

ACCORDING TO THE PUBLIC RECORDS, THE BENEFICIAL INTEREST UNDER THE DEED OF TRUST WAS ASSIGNED TO BANK OF AMERICA, N.A., SUCCESSOR BY MERGER TO BAC HOME LOANS SERVICING, LP FKA COUNTRYWIDE HOME LOANS SERVICING, LP BY ASSIGNMENT RECORDED SEPTEMBER 19, 2011 AS 201109190491 OF OFFICIAL RECORDS.
A DOCUMENT RECORDED JANUARY 30, 2013 AS 201301300329 OF OFFICIAL RECORDS PROVIDES THAT NORTHWEST TRUSTEE SERVICES, INC., A WASHINGTON CORPORATION WAS SUBSTITUTED AS TRUSTEE UNDER THE DEED OF TRUST.

ITEM F11) EVIDENCE OF THE AUTHORITY OF THE INDIVIDUAL(S) TO EXECUTE THE FORTHCOMING DOCUMENT FOR VECTOR WASHINGTON LLC, COPIES OF THE CURRENT OPERATING AGREEMENT SHOULD BE SUBMITTED PRIOR TO CLOSING. **(NON SURVEY RELATED ITEM)**

PARCEL G
GRELIS (APN 042020-1101) FIRSTAM ORDER 4266-3348684, OCTOBER 24, 2019
THE EAST 322 FEET OF THE WEST 616 FEET OF THE SOUTH HALF OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SECTION 20, TOWNSHIP 20 NORTH, RANGE 4 EAST OF THE WILLAMETTE MERIDIAN.

TOGETHER WITH A NON-EXCLUSIVE EASEMENT FOR INGRESS, EGRESS AND UTILITIES 60 FEET IN WIDTH AS GRANTED BY INSTRUMENT RECORDED JULY 30, 1980 UNDER RECORDING NO. 3005857.

SITUATE IN THE COUNTY OF PIERCE, STATE OF WASHINGTON.

SPECIAL EXCEPTIONS: [FIRST AMERICAN TITLE INSURANCE COMPANY COMMITMENT NO. 4266-3348684]
ITEM G1) ANY DEFECT, LIEN, ENCUMBRANCE, ADVERSE CLAIM, OR OTHER MATTER THAT APPEARS FOR THE FIRST TIME IN THE PUBLIC RECORDS OR IS CREATED, ATTACHES, OR IS DISCLOSED BETWEEN THE COMMITMENT DATE AND THE DATE ON WHICH ALL OF THE SCHEDULE B, PART I–REQUIREMENTS ARE MET. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM G2) TAXES OR ASSESSMENTS WHICH ARE NOT SHOWN AS EXISTING LIENS BY THE RECORDS OF ANY TAXING AUTHORITY THAT LEVIES TAXES OR ASSESSMENTS ON REAL PROPERTY OR BY THE PUBLIC RECORDS. **(NON SURVEY RELATED ITEM)**

ITEM G3) ANY FACTS, RIGHTS, INTERESTS, OR CLAIMS WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS BUT WHICH COULD BE ASCERTAINED BY AN INSPECTION OF THE LAND OR BY MAKING INQUIRY OF PERSONS IN POSSESSION THEREOF. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM G4) EASEMENTS, CLAIMS OF EASEMENT OR ENCUMBRANCES WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM G5) DISCREPANCIES, CONFLICTS IN BOUNDARY LINES, SHORTAGE IN AREA, ENCROACHMENTS, OR ANY OTHER FACTS WHICH A CORRECT SURVEY WOULD DISCLOSE, AND WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM G6) (A) UNPATENTED MINING CLAIMS; (B) RESERVATIONS OR EXCEPTIONS IN PATENTS OR IN ACTS AUTHORIZING THE ISSUANCE THEREOF; (C) WATER RIGHTS, CLAIMS OR TITLE TO WATER; WHETHER OR NOT THE MATTERS EXCEPTED UNDER (A), (B) OR (C) ARE SHOWN BY THE PUBLIC RECORDS; (D) INDIAN TRIBAL CODES OR REGULATIONS, INDIAN TREATY OR ABORIGINAL RIGHTS, INCLUDING EASEMENTS OR EQUITABLE SERVITUDES. **(NON SURVEY RELATED ITEM)**

ITEM G7) ANY LIEN, OR RIGHT TO A LIEN, FOR SERVICES, LABOR OR MATERIALS OR MEDICAL ASSISTANCE HERETOFORE OR HEREAFTER FURNISHED, IMPOSED BY LAW AND NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM G8) ANY SERVICE, INSTALLATION, CONNECTION, MAINTENANCE, CONSTRUCTION, TAP OR REIMBURSEMENT CHARGES/COSTS FOR SEWER, WATER, GARBAGE OR ELECTRICITY. **(NON SURVEY RELATED ITEM)**

ITEMS G9–G10) TAX RELATED **(NON SURVEY RELATED ITEMS)**

ITEM G11) TERMS, PROVISIONS, CONDITIONS OF THE TRUST AGREEMENT OF THE MAYNE D. GRELIS LIVING TRUST , AND ANY SUBSEQUENT MODIFICATIONS, A COPY OF WHICH SHOULD BE SUBMITTED TO THIS OFFICE FOR INSPECTION. **(NON SURVEY RELATED ITEM)**

ITEM G12) EVIDENCE OF THE AUTHORITY OF THE INDIVIDUAL(S) TO EXECUTE THE FORTHCOMING DOCUMENT FOR VECTOR WASHINGTON LLC, COPIES OF THE CURRENT OPERATING AGREEMENT SHOULD BE SUBMITTED PRIOR TO CLOSING.

ITEM G13) MATTERS OF EXTENDED OWNER/PURCHASER COVERAGE WHICH ARE DEPENDENT UPON AN INSPECTION AND AN ALTA SURVEY OF THE PROPERTY FOR DETERMINATION OF INSURABILITY. PLEASE SUBMIT A COPY OF THE ALTA SURVEY AT YOUR EARLIEST CONVENIENCE FOR REVIEW. OUR INSPECTION WILL BE HELD PENDING OUR REVIEW OF THE ALTA SURVEY AND THE RESULT OF SAID INSPECTION WILL BE FURNISHED BY SUPPLEMENTAL REPORT. **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM G14) EASEMENT, INCLUDING TERMS AND PROVISIONS CONTAINED THEREIN:
RECORDING INFORMATION: 782013
IN FAVOR OF: PUGET SOUND POWER & LIGHT COMPANY, A MASSACHUSETTS CORPORATION
FOR: CONSTRUCT, ERECT, ALTER, IMPROVE, REPAIR, OPERATE AND MAINTAIN AN ELECTRIC TRANSMISSION AND DISTRIBUTION LINE
AFFECTS: SOUTHERLY PORTION OF SAID PREMISES **(EASEMENT DOES NOT EFFECT SUBJECT PROPERTY, THEREFORE NOT SHOWN)**

ITEM G15) CONDITIONS, NOTES, EASEMENTS, PROVISIONS AND/OR ENCROACHMENTS CONTAINED AND/OR DELINEATED ON THE FACE OF THE SURVEY NO. 3204, RECORDED IN VOLUME 33 OF SURVEYS, AT PAGE(S) 4, IN PIERCE COUNTY, WASHINGTON. **(SEE SURVEY FOR EXISTING CONDITIONS)**

PARCEL H
JOHNSON (APN 042020-5003) FIRSTAM ORDER 4269-3445550, APRIL 3, 2020
LOT 1, PIERCE CO. SHORT PLAT NO. 8009280306, ACCORDING TO SHORT PLAT RECORDED SEPTEMBER 28, 1980 WHICH IS A RE-RECORD OF PIERCE CO. SHORT PLAT NO. 75-171, ACCORDING TO SHORT PLAT RECORDED JUNE 5, 1975, RECORDS OF PIERCE COUNTY AUDITOR.

**SPECIAL EXCEPTIONS: [FIRST AMERICA

EXISTING CONDITIONS - LEGAL DESCRIPTIONS

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

LEGAL DESCRIPTIONS:

PARCEL I
VOLK (APN 042022-5016) FIRSTAM ORDER 4269-3456051 APRIL 20, 2020
LOT 1, PIERCE COUNTY SHORT PLAT, ACCORDING TO PLAT RECORDED MARCH 23, 1994 UNDER RECORDING NO. 9403231137, IN PIERCE COUNTY, WASHINGTON.

SPECIAL EXCEPTIONS: [FIRST AMERICAN TITLE INSURANCE COMPANY COMMITMENT NO. 4269-3456051]
ITEM I1) ANY DEFECT, LIEN, ENCUMBRANCE, ADVERSE CLAIM, OR OTHER MATTER THAT APPEARS FOR THE FIRST TIME IN THE PUBLIC RECORDS OR IS CREATED, ATTACHES, OR IS DISCLOSED BETWEEN THE COMMITMENT DATE AND THE DATE ON WHICH ALL OF THE SCHEDULE B, PART I–REQUIREMENTS ARE MET. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM I2) TAXES OR ASSESSMENTS WHICH ARE NOT SHOWN AS EXISTING LIENS BY THE RECORDS OF ANY TAXING AUTHORITY THAT LEVIES TAXES OR ASSESSMENTS ON REAL PROPERTY OR BY THE PUBLIC RECORDS. **(NON SURVEY RELATED ITEM)**

ITEM I3) ANY FACTS, RIGHTS, INTERESTS, OR CLAIMS WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS BUT WHICH COULD BE ASCERTAINED BY AN INSPECTION OF THE LAND OR BY MAKING INQUIRY OF PERSONS IN POSSESSION THEREOF. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM I4) EASEMENTS, CLAIMS OF EASEMENT OR ENCUMBRANCES WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM I5) DISCREPANCIES, CONFLICTS IN BOUNDARY LINES, SHORTAGE IN AREA, ENCROACHMENTS, OR ANY OTHER FACTS WHICH A CORRECT SURVEY WOULD DISCLOSE, AND WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM I6) (A) UNPATENTED MINING CLAIMS; (B) RESERVATIONS OR EXCEPTIONS IN PATENTS OR IN ACTS AUTHORIZING THE ISSUANCE THEREOF; (C) WATER RIGHTS, CLAIMS OR TITLE TO WATER; WHETHER OR NOT THE MATTERS EXCEPTED UNDER (A), (B) OR (C) ARE SHOWN BY THE PUBLIC RECORDS; (D) INDIAN TRIBAL CODES OR REGULATIONS, INDIAN TREATY OR ABORIGINAL RIGHTS, INCLUDING EASEMENTS OR EQUITABLE SERVITUDES. **(NON SURVEY RELATED ITEM)**

ITEM I7) ANY LIEN, OR RIGHT TO A LIEN, FOR SERVICES, LABOR OR MATERIALS OR MEDICAL ASSISTANCE HERETOFORE OR HEREAFTER FURNISHED, IMPOSED BY LAW AND NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM I8) ANY SERVICE, INSTALLATION, CONNECTION, MAINTENANCE, CONSTRUCTION, TAP OR REIMBURSEMENT CHARGES/COSTS FOR SEWER, WATER, GARBAGE OR ELECTRICITY. **(NON SURVEY RELATED ITEM)**

ITEMS I9–I10) TAX RELATED. **(NON SURVEY RELATED ITEMS)**

ITEM I11) DEED OF TRUST AND THE TERMS AND CONDITIONS THEREOF.
GRANTOR/TRUSTOR: DALE VOLK, A SINGLE INDIVIDUAL
GRANTEE/BENEFICIARY: MORTGAGE ELECTRONIC REGISTRATION SYSTEMS, INC., "MERS" SOLELY AS A NOMINEE FOR UNIVERSAL AMERICAN MORTGAGE COMPANY, LLC, ITS SUCCESSORS AND ASSIGNS
TRUSTEE: FIRST AMERICAN TITLE
DATED: JULY 09, 2012
RECORDED: JULY 13, 2012
RECORDING INFORMATION: 201207130404

ITEM I12) THE LAND DESCRIBED IN THIS COMMITMENT APPEARS TO BE RESIDENTIAL IN NATURE AND MAY BE SUBJECT TO THE PROVISIONS OF R.C.W. 6.13.010, ET SEQ. (HOMESTEAD STATUTE) IF THE LAND IS OCCUPIED AS A PRIMARY RESIDENCE. IF THE LAND IS OCCUPIED AS A PRIMARY RESIDENCE, R.C.W. 6.13.060 REQUIRES THAT ALL DOCUMENTS CONVEYING OR ENCUMBERING THE LAND MUST BE EXECUTED BY EACH SPOUSE OR DOMESTIC PARTNER, INDIVIDUALLY. ALTERNATIVELY, THE COMPANY WILL ACCEPT A DEED IDENTIFYING THE NON-VESTED SPOUSE OCCUPYING THE PROPERTY AS THE GRANTOR AND THE VESTED SPOUSE AS THE GRANTEE. IN THE EVENT THAT THE COMPANY RECEIVES DOCUMENTS TO INSURE THAT ARE NOT EXECUTED AS REQUIRED, THE COMPANY MAY BE UNABLE TO RECORD OR TO INSURE THE TRANSACTION. PLEASE CONTACT YOUR TITLE OFFICER IF YOU HAVE ANY QUESTIONS. **(NON SURVEY RELATED ITEM)**

ITEM I13) EASEMENT, INCLUDING TERMS AND PROVISIONS CONTAINED THEREIN:
RECORDING INFORMATION: 1295136
IN FAVOR OF: PUGET SOUND POWER AND LIGHT COMPANY, A MASSACHUSETTS CORPORATION
FOR: ELECTRIC TRANSMISSION AND DISTRIBUTION LINE **(SHOWN HEREON)**

ITEM I14) THE TERMS AND PROVISIONS CONTAINED IN THE DOCUMENT ENTITLED "TITLE NOTIFICATION"
RECORDED: MARCH 31, 1994
RECORDING NO.: 9403310264 **(NON SURVEY RELATED ITEM)**

ITEM I15) EASEMENT, INCLUDING TERMS AND PROVISIONS CONTAINED THEREIN:
RECORDED: APRIL 12, 1994
RECORDING INFORMATION: 9404120568
IN FAVOR OF: PUGET SOUND ENERGY, INC., A WASHINGTON CORPORATION
FOR: ELECTRIC AND/OR GAS TRANSMISSION AND/OR DISTRIBUTION SYSTEM **(SHOWN HEREON)**

ITEM I16) THERE ARE VARIOUS ONGOING CLOSURES AND INACCESSIBILITY OF CERTAIN RECORDS IN COUNTIES AND MUNICIPALITIES ACROSS THE COUNTRY DUE TO THE COVID-19 EMERGENCY. IF UNABLE TO RECORD DOCUMENTS IN THE PUBLIC RECORDS DUE TO CLOSURE OR INACCESSIBILITY, EXECUTION OF A DECLARATION OF UNDERSTANDING AND INDEMNITY AND HOLD HARMLESS AGREEMENT DUE TO THE COVID-19 EMERGENCY IS REQUIRED BY THE PARTIES (OTHER THAN THE LENDER) TO THE CONTEMPLATED TRANSACTION. **(NON SURVEY RELATED ITEM)**

PARCEL J
LANE (APN 042020-1052) FIRSTAM ORDER 4269-3458157 APRIL 21, 2020
BEGINNING AT THE NORTHWEST CORNER OF THE NORTHWEST QUARTER OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SECTION 20, TOWNSHIP 20 NORTH, RANGE 4 EAST OF THE WILLAMETTE MERIDIAN;

THENCE SOUTH 340.83 FEET;
THENCE EAST 300 FEET;
THENCE SOUTH 68.17 FEET;
THENCE WEST 300 FEET;
THENCE NORTH 68.17 FEET TO THE POINT OF BEGINNING;

EXCEPT FREEMAN COUNTY ROAD RUNNING ALONG THE WEST LINE THEREOF ALSO, COMMENCING 15 FEET EAST AND 272.86 FEET SOUTH OF THE NORTHWEST CORNER OF THE NORTHWEST QUARTER OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SECTION 20, TOWNSHIP 20 NORTH, RANGE 4 EAST OF THE WILLAMETTE MERIDIAN;

THENCE EAST PARALLEL WITH THE SOUTH LINE OF THE NORTHWEST QUARTER OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SAID SECTION, 330 FEET;
THENCE SOUTH PARALLEL WITH THE CENTER LINE OF FREEMAN COUNTY ROAD 68.17 FEET;
THENCE WEST 142 FEET TO THE TRUE POINT OF BEGINNING;
THENCE NORTH 20 FEET;
THENCE WEST 20 FEET;
THENCE SOUTH 20 FEET;
THENCE EAST 20 FEET TO THE TRUE POINT OF BEGINNING.

SPECIAL EXCEPTIONS: [FIRST AMERICAN TITLE INSURANCE COMPANY COMMITMENT NO. 4269-3458157]
ITEM J1) ANY DEFECT, LIEN, ENCUMBRANCE, ADVERSE CLAIM, OR OTHER MATTER THAT APPEARS FOR THE FIRST TIME IN THE PUBLIC RECORDS OR IS CREATED, ATTACHES, OR IS DISCLOSED BETWEEN THE COMMITMENT DATE AND THE DATE ON WHICH ALL OF THE SCHEDULE B, PART I–REQUIREMENTS ARE MET. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM J2) TAXES OR ASSESSMENTS WHICH ARE NOT SHOWN AS EXISTING LIENS BY THE RECORDS OF ANY TAXING AUTHORITY THAT LEVIES TAXES OR ASSESSMENTS ON REAL PROPERTY OR BY THE PUBLIC RECORDS. **(NON SURVEY RELATED ITEM)**

ITEM J3) ANY FACTS, RIGHTS, INTERESTS, OR CLAIMS WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS BUT WHICH COULD BE ASCERTAINED BY AN INSPECTION OF THE LAND OR BY MAKING INQUIRY OF PERSONS IN POSSESSION THEREOF. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM J4) EASEMENTS, CLAIMS OF EASEMENT OR ENCUMBRANCES WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM J5) DISCREPANCIES, CONFLICTS IN BOUNDARY LINES, SHORTAGE IN AREA, ENCROACHMENTS, OR ANY OTHER FACTS WHICH A CORRECT SURVEY WOULD DISCLOSE, AND WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM J6) (A) UNPATENTED MINING CLAIMS; (B) RESERVATIONS OR EXCEPTIONS IN PATENTS OR IN ACTS AUTHORIZING THE ISSUANCE THEREOF; (C) WATER RIGHTS, CLAIMS OR TITLE TO WATER; WHETHER OR NOT THE MATTERS EXCEPTED UNDER (A), (B) OR (C) ARE SHOWN BY THE PUBLIC RECORDS; (D) INDIAN TRIBAL CODES OR REGULATIONS, INDIAN TREATY OR ABORIGINAL RIGHTS, INCLUDING EASEMENTS OR EQUITABLE SERVITUDES. **(NON SURVEY RELATED ITEM)**

ITEM J7) ANY LIEN, OR RIGHT TO A LIEN, FOR SERVICES, LABOR OR MATERIALS OR MEDICAL ASSISTANCE HERETOFORE OR HEREAFTER FURNISHED, IMPOSED BY LAW AND NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM J8) ANY SERVICE, INSTALLATION, CONNECTION, MAINTENANCE, CONSTRUCTION, TAP OR REIMBURSEMENT CHARGES/COSTS FOR SEWER, WATER, GARBAGE OR ELECTRICITY. **(NON SURVEY RELATED ITEM)**

ITEMS J9–J10) TAX RELATED **(NON SURVEY RELATED)**

ITEM J11) DEED OF TRUST AND THE TERMS AND CONDITIONS THEREOF.
GRANTOR/TRUSTOR: ALISHA LANE AND JEREME LANE, WIFE AND HUSBAND
GRANTEE/BENEFICIARY: MORTGAGE ELECTRONIC REGISTRATION SYSTEMS, INC., "MERS" SOLELY AS A NOMINEE FOR CALIBER HOME LOANS, INC., ITS SUCCESSORS AND ASSIGNS
TRUSTEE: FIRST AMERICAN TITLE INSURANCE COMPANY
DATED: DECEMBER 22, 2016
RECORDED: DECEMBER 27, 2016
RECORDING INFORMATION: 201612271077

ITEM J12) EVIDENCE OF THE AUTHORITY OF THE INDIVIDUAL(S) TO EXECUTE THE FORTHCOMING DOCUMENT FOR VECTOR WASHINGTON LLC, COPIES OF THE CURRENT OPERATING AGREEMENT SHOULD BE SUBMITTED PRIOR TO CLOSING. **(NON SURVEY RELATED ITEM)**

ITEM J13) THE TERMS AND PROVISIONS CONTAINED IN THE DOCUMENT ENTITLED "WAIVER OF CLAIM FOR DAMAGES AND CONSENT TO LOCATE ROAD"
RECORDED: APRIL 7, 1911
RECORDING NO.: 337244 **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM J14) EASEMENT, INCLUDING TERMS AND PROVISIONS CONTAINED THEREIN:
RECORDING INFORMATION: 1295136
IN FAVOR OF: PUGET SOUND POWER & LIGHT COMPANY
FOR: ELECTRIC TRANSMISSION AND/OR DISTRIBUTION SYSTEM **(SHOWN HEREON)**

ITEM J15) THERE ARE VARIOUS ONGOING CLOSURES AND INACCESSIBILITY OF CERTAIN RECORDS IN COUNTIES AND MUNICIPALITIES ACROSS THE COUNTRY DUE TO THE COVID-19 EMERGENCY. IF UNABLE TO RECORD DOCUMENTS IN THE PUBLIC RECORDS DUE TO CLOSURE OR INACCESSIBILITY, EXECUTION OF A DECLARATION OF UNDERSTANDING AND INDEMNITY AND HOLD HARMLESS AGREEMENT DUE TO THE COVID-19 EMERGENCY IS REQUIRED BY THE PARTIES (OTHER THAN THE LENDER) TO THE CONTEMPLATED TRANSACTION. **(NON SURVEY RELATED ITEM)**

PARCEL K
O'CONNER (APN 042020-1034) FIRSTAM ORDER 4269-3514609 JUNE 23, 2020.
BEGINNING 15 FEET EAST AND 272.66 FEET SOUTH OF THE NORTHWEST CORNER OF THE NORTHWEST QUARTER OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SECTION 20, TOWNSHIP 20 NORTH, RANGE 4 EAST OF THE W.M., IN PIERCE COUNTY, WASHINGTON;
THENCE EAST PARALLEL WITH THE SOUTH LINE OF THE NORTHWEST QUARTER OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SAID SECTION 20, 330 FEET;
THENCE SOUTH PARALLEL WITH THE CENTER LINE OF FREEMAN COUNTY ROAD, 68.17 FEET;
THENCE WEST 330 FEET TO THE EAST LINE OF SAID ROAD;
THENCE NORTH ALONG SAID EAST LINE 68.17 FEET TO THE POINT OF BEGINNING.

EXCEPT, COMMENCING AT A POINT 142 FEET WEST OF THE SOUTHEAST CORNER OF THE ABOVE DESCRIBED TRACT;
THENCE NORTH 20 FEET;
THENCE WEST 20 FEET; THENCE SOUTH TO SOUTH LINE OF ABOVE DESCRIBED TRACT;
THENCE EAST ALONG SAID SOUTH LINE TO POINT OF BEGINNING.

SPECIAL EXCEPTIONS: [FIRST AMERICAN TITLE INSURANCE COMPANY COMMITMENT NO. 4269-3514609]
ITEM K1) ANY DEFECT, LIEN, ENCUMBRANCE, ADVERSE CLAIM, OR OTHER MATTER THAT APPEARS FOR THE FIRST TIME IN THE PUBLIC RECORDS OR IS CREATED, ATTACHES, OR IS DISCLOSED BETWEEN THE COMMITMENT DATE AND THE DATE ON WHICH ALL OF THE SCHEDULE B, PART I–REQUIREMENTS ARE MET. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM K2) TAXES OR ASSESSMENTS WHICH ARE NOT SHOWN AS EXISTING LIENS BY THE RECORDS OF ANY TAXING AUTHORITY THAT LEVIES TAXES OR ASSESSMENTS ON REAL PROPERTY OR BY THE PUBLIC RECORDS. **(NON SURVEY RELATED ITEM)**

ITEM K3) ANY FACTS, RIGHTS, INTERESTS, OR CLAIMS WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS BUT WHICH COULD BE ASCERTAINED BY AN INSPECTION OF THE LAND OR BY MAKING INQUIRY OF PERSONS IN POSSESSION THEREOF. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM K4) EASEMENTS, CLAIMS OF EASEMENT OR ENCUMBRANCES WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM K5) DISCREPANCIES, CONFLICTS IN BOUNDARY LINES, SHORTAGE IN AREA, ENCROACHMENTS, OR ANY OTHER FACTS WHICH A CORRECT SURVEY WOULD DISCLOSE, AND WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM K6) (A) UNPATENTED MINING CLAIMS; (B) RESERVATIONS OR EXCEPTIONS IN PATENTS OR IN ACTS AUTHORIZING THE ISSUANCE THEREOF; (C) WATER RIGHTS, CLAIMS OR TITLE TO WATER; WHETHER OR NOT THE MATTERS EXCEPTED UNDER (A), (B) OR (C) ARE SHOWN BY THE PUBLIC RECORDS; (D) INDIAN TRIBAL CODES OR REGULATIONS, INDIAN TREATY OR ABORIGINAL RIGHTS, INCLUDING EASEMENTS OR EQUITABLE SERVITUDES. **(NON SURVEY RELATED ITEM)**

ITEM K7) ANY LIEN, OR RIGHT TO A LIEN, FOR SERVICES, LABOR OR MATERIALS OR MEDICAL ASSISTANCE HERETOFORE OR HEREAFTER FURNISHED, IMPOSED BY LAW AND NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM K8) ANY SERVICE, INSTALLATION, CONNECTION, MAINTENANCE, CONSTRUCTION, TAP OR REIMBURSEMENT CHARGES/COSTS FOR SEWER, WATER, GARBAGE OR ELECTRICITY. **(NON SURVEY RELATED ITEM)**

ITEMS K9–K10) TAX RELATED. **(NON SURVEY RELATED ITEMS)**

ITEM K11) DEED OF TRUST AND THE TERMS AND CONDITIONS THEREOF.
GRANTOR/TRUSTOR: MICHAEL P. O'CONNOR AND TERESA L.G. O'CONNOR, HUSBAND AND WIFE
GRANTEE/BENEFICIARY: MORTGAGE ELECTRONIC REGISTRATION SYSTEMS, INC., "MERS" SOLELY AS A NOMINEE FOR HOMESTREET BANK, ITS SUCCESSORS AND ASSIGNS
TRUSTEE: CHICAGO TITLE INSURANCE COMPANY, A MISSOURI CORPORATION
DATED: APRIL 22, 2003
RECORDED: APRIL 28, 2003
RECORDING INFORMATION: 200304280650

ITEM K12) DEED OF TRUST AND THE TERMS AND CONDITIONS THEREOF.
GRANTOR/TRUSTOR: MICHAEL P. O'CONNOR AND TERESA L. O'CONNOR, HUSBAND AND WIFE
GRANTEE/BENEFICIARY: MORTGAGE ELECTRONIC REGISTRATION SYSTEMS, INC., "MERS" SOLELY AS A NOMINEE FOR HOMESTREET BANK, ITS SUCCESSORS AND ASSIGNS
TRUSTEE: FIRST AMERICAN TITLE
DATED: DECEMBER 14, 2007
RECORDED: JANUARY 03, 2008
RECORDING INFORMATION: 200801030037
NOTE: THIS DEED OF TRUST CONTAINS LINE OF CREDIT PRIVILEGES. IF THE CURRENT BALANCE OWING ON SAID OBLIGATION IS TO BE PAID IN FULL IN THE FORTHCOMING TRANSACTION, CONFIRMATION SHOULD BE MADE THAT THE BENEFICIARY WILL ISSUE A PROPER REQUEST FOR FULL RECONVEYANCE.

ITEM K13) FEDERAL TAX LIEN:
TAXPAYER: MICHEAL OCONNOR
CERTIFICATE NO.: 358597519
RECORDED: MAY 20, 2019
RECORDING INFORMATION: 201905200742 **(NON SURVEY RELATED ITEM)**

ITEM K14) THE EFFECT OF THE MATTER(S) SHOWN IN PARAGRAPH(S) 13 HEREIN DEPENDS UPON THE IDENTITY OF THE DEBTOR/TAXPAYER WITH THE NAME(S) OF MICHAEL P. O'CONNOR. THE ENCLOSED IDENTITY AFFIDAVIT SHOULD BE COMPLETED AND RETURNED TO THIS OFFICE TO HELP DETERMINE THE IDENTITY OF SAID PARTY(S) PRIOR TO CLOSING. **(NON SURVEY RELATED ITEM)**

ITEM K15) EVIDENCE OF THE AUTHORITY OF THE INDIVIDUAL(S) TO EXECUTE THE FORTHCOMING DOCUMENT FOR VECTOR WASHINGTON, LLC, A WASHINGTON LIMITED LIABILITY COMPANY, COPIES OF THE CURRENT OPERATING AGREEMENT SHOULD BE SUBMITTED PRIOR TO CLOSING. **(NON SURVEY RELATED ITEM)**

ITEM K16) MATTERS OF EXTENDED OWNER/PURCHASER COVERAGE WHICH ARE DEPENDENT UPON AN INSPECTION AND AN ALTA SURVEY OF THE PROPERTY FOR DETERMINATION OF INSURABILITY. PLEASE SUBMIT A COPY OF THE ALTA SURVEY AT YOUR EARLIEST CONVENIENCE FOR REVIEW. OUR INSPECTION WILL BE HELD PENDING OUR REVIEW OF THE ALTA SURVEY AND THE RESULT OF SAID INSPECTION WILL BE FURNISHED BY SUPPLEMENTAL REPORT. **(NON SURVEY RELATED ITEM)**

ITEM K17) EASEMENT, INCLUDING TERMS AND PROVISIONS CONTAINED THEREIN:
RECORDING INFORMATION: 1295136
IN FAVOR OF: PUGET SOUND ENERGY, INC., A WASHINGTON CORPORATION
FOR: ELECTRIC AND/OR GAS TRANSMISSION AND/OR DISTRIBUTION SYSTEM **(SHOWN HEREON)**

ITEM K18) RIGHT OF WAY, INCLUDING TERMS AND CONDITIONS CONTAINED THEREIN:
GRANTED TO: MICHAEL AND TERESA O'CONNOR
FOR: INSTALLATION OF A DRIVEWAY
RECORDED: OCTOBER 18, 2012
RECORDING INFORMATION: 201210180342 **(SHOWN HEREON)**

ITEM K19) CONDITIONS, NOTES, EASEMENTS, PROVISIONS AND/OR ENCROACHMENTS CONTAINED OR DELINEATED ON THE FACE OF THE SURVEY RECORDED UNDER RECORDING NO. 201311085007. **(SEE SURVEY FOR EXISTING CONDITIONS)**

PARCEL L
ANNON (APN 042020-1034) FIRSTAM ORDER 4269-3644487 DECEMBER 17, 2020.
COMMENCING AT THE NORTHWEST CORNER OF THE NORTHWEST QUARTER OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SECTION 20, TOWNSHIP 20, RANGE 4 EAST OF W.M.;
THENCE EAST 345 FEET TO THE POINT OF BEGINNING;
THENCE SOUTH 408.4 FEET MORE OR LESS;
THENCE EAST 110.6 FEET;
THENCE NORTH 408.4 FEET MORE OR LESS TO THE NORTH LINE OF SAID SUBDIVISION;
THENCE WEST 110.6 FEET TO THE POINT OF BEGINNING.

EXCEPT ROADS SUBJECT TO EASEMENT.

SPECIAL EXCEPTIONS: [FIRST AMERICAN TITLE INSURANCE COMPANY COMMITMENT NO. 4269-3644487]
ITEM L1) ANY DEFECT, LIEN, ENCUMBRANCE, ADVERSE CLAIM, OR OTHER MATTER THAT APPEARS FOR THE FIRST TIME IN THE PUBLIC RECORDS OR IS CREATED, ATTACHES, OR IS DISCLOSED BETWEEN THE COMMITMENT DATE AND THE DATE ON WHICH ALL OF THE SCHEDULE B, PART I–REQUIREMENTS ARE MET. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM L2) TAXES OR ASSESSMENTS WHICH ARE NOT SHOWN AS EXISTING LIENS BY THE RECORDS OF ANY TAXING AUTHORITY THAT LEVIES TAXES OR ASSESSMENTS ON REAL PROPERTY OR BY THE PUBLIC RECORDS. **(NON SURVEY RELATED ITEM)**

ITEM L3) ANY FACTS, RIGHTS, INTERESTS, OR CLAIMS WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS BUT WHICH COULD BE ASCERTAINED BY AN INSPECTION OF THE LAND OR BY MAKING INQUIRY OF PERSONS IN POSSESSION THEREOF. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM L4) EASEMENTS, CLAIMS OF EASEMENT OR ENCUMBRANCES WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM L5) DISCREPANCIES, CONFLICTS IN BOUNDARY LINES, SHORTAGE IN AREA, ENCROACHMENTS, OR ANY OTHER FACTS WHICH A CORRECT SURVEY WOULD DISCLOSE, AND WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM L6) (A) UNPATENTED MINING CLAIMS; (B) RESERVATIONS OR EXCEPTIONS IN PATENTS OR IN ACTS AUTHORIZING THE ISSUANCE THEREOF; (C) WATER RIGHTS, CLAIMS OR TITLE TO WATER; WHETHER OR NOT THE MATTERS EXCEPTED UNDER (A), (B) OR (C) ARE SHOWN BY THE PUBLIC RECORDS; (D) INDIAN TRIBAL CODES OR REGULATIONS, INDIAN TREATY OR ABORIGINAL RIGHTS, INCLUDING EASEMENTS OR EQUITABLE SERVITUDES. **(NON SURVEY RELATED ITEM)**

ITEM L7) ANY LIEN, OR RIGHT TO A LIEN, FOR SERVICES, LABOR OR MATERIALS OR MEDICAL ASSISTANCE HERETOFORE OR HEREAFTER FURNISHED, IMPOSED BY LAW AND NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM L8) ANY SERVICE, INSTALLATION, CONNECTION, MAINTENANCE, CONSTRUCTION, TAP OR REIMBURSEMENT CHARGES/COSTS FOR SEWER, WATER, GARBAGE OR ELECTRICITY. **(NON SURVEY RELATED ITEM)**

ITEM L9) TAX RELATED. **(NON SURVEY RELATED ITEM)**

ITEM L10) THE LEGAL DESCRIPTION FOR SAID PREMISES IS DERIVED FROM A LACK OF PROBATE AFFIDAVIT RECORDED UNDER RECORDING NUMBER 201808202083. SAID DESCRIPTION IS IMPRECISE, FOR THOUGH IT HAS A 408.4-FOOT SOUTHERLY CALL, THE TEXT 'MORE OR LESS' IS ADDED TO IT WITHOUT TYING IT TO ANYTHING DEFINITE. THUS, THE TERM 'MORE OR LESS' NULLIFIES THE DISTANCE CALL AND RENDERS US INCAPABLE OF PRECISELY IDENTIFYING THE SOUTHERLY BOUNDARY OF SAID PREMISES. THE COMPANY, THEREFORE, DOES NOT INSURE AGAINST ANY CLAIMS RELATING TO SAID SOUTHERLY BOUNDARY. MOREOVER, SAID DESCRIPTION EXCLUDES 'ROADS,' BUT NO ROADS APPEAR TO BE INCLUDED IN SAID DESCRIPTION. WE RESERVE OPINION PENDING SUBMISSION OF PERTINENT FACTS. **(TITLE COMPANY CONCERN)**

ITEM L11) EASEMENT, INCLUDING TERMS AND PROVISIONS CONTAINED THEREIN:
RECORDING INFORMATION: 1295136
IN FAVOR OF: PUGET SOUND POWER & LIGHT COMPANY, A MASSACHUSETTS CORPORATION
FOR: AN ELECTRIC TRANSMISSION AND DISTRIBUTION LINE **(SHOWN HEREON)**

ITEM L12) MATTERS OF EXTENDED OWNER/PURCHASER COVERAGE WHICH ARE DEPENDENT UPON AN INSPECTION AND AN ALTA SURVEY OF THE PROPERTY FOR DETERMINATION OF INSURABILITY. PLEASE SUBMIT A COPY OF THE ALTA SURVEY AT YOUR EARLIEST CONVENIENCE FOR REVIEW. OUR INSPECTION WILL BE HELD PENDING OUR REVIEW OF THE ALTA SURVEY AND THE RESULT OF SAID INSPECTION WILL BE FURNISHED BY SUPPLEMENTAL REPORT. **(SEE SURVEY FOR EXISTING CONDITIONS)**

PARCEL M: (APN 0420201036)

BEGINNING AT THE NORTHWEST CORNER OF THE SOUTH HALF OF THE NORTHEAST QUARTER OF THE NORTHEAST QUARTER OF SECTION 20, TOWNSHIP 20 NORTH, RANGE 4 EAST OF THE WILLAMETTE MERIDIAN;
THENCE SOUTH 297.5 FEET;
THENCE EAST 294 FEET;
THENCE NORTH 297.5 FEET;
THENCE WEST 294 FEET TO THE POINT OF BEGINNING;

EXCEPT THE WEST 15 FEET THEREOF FOR COUNTY ROAD;

SITUATE IN THE CITY OF PUYALLUP, COUNTY OF PIERCE, STATE OF WASHINGTON.

PARCEL N: (APN 0420205004)

LOT 2, PIERCE COUNTY SHORT PLAT NUMBER 8009260306, ACCORDING TO THE PLAT THEREOF RECORDED SEPTEMBER 26, 1980 WHICH IS A RE-RECORD OF PIERCE COUNTY SHORT PLAT NUMBER 75-171, ACCORDING TO THE PLAT THEREOF RECORDED JUNE 5, 1975, RECORDS OF THE PIERCE COUNTY AUDITOR;

SITUATE IN THE CITY OF PUYALLUP, COUNTY OF PIERCE, STATE OF WASHINGTON.

SPECIAL EXCEPTIONS:
ITEM 1) ANY DEFECT, LIEN, ENCUMBRANCE, ADVERSE CLAIM, OR OTHER MATTER THAT APPEARS FOR THE FIRST TIME IN THE PUBLIC RECORDS OR IS CREATED, ATTACHES, OR IS DISCLOSED BETWEEN THE COMMITMENT DATE AND THE DATE ON WHICH ALL OF THE SCHEDULE B, PART I–REQUIREMENTS ARE MET. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM 2) TAXES OR ASSESSMENTS **(NON SURVEY RELATED ITEMS)**

ITEM 3) ANY FACTS, RIGHTS, INTERESTS, OR CLAIMS WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS BUT WHICH COULD BE ASCERTAINED BY AN INSPECTION OF THE LAND OR BY MAKING INQUIRY OF PERSONS IN POSSESSION THEREOF. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM 4) EASEMENTS, CLAIMS OF EASEMENT OR ENCUMBRANCES WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SURVEYOR IS NOT AWARE OF ANY)**

ITEM 5) DISCREPANCIES, CONFLICTS IN BOUNDARY LINES, SHORTAGE IN AREA, ENCROACHMENTS, OR ANY OTHER FACTS WHICH A CORRECT SURVEY WOULD DISCLOSE, AND WHICH ARE NOT SHOWN BY THE PUBLIC RECORDS. **(SEE SURVEY FOR EXISTING CONDITIONS)**

ITEM 6) REFERS TO MINING CLAIMS; **(NON SURVEY RELATED ITEM)**

ITEM 7) ANY LIEN, OR RIGHT TO A LIEN, FOR SERVICES, LABOR OR MATERIALS OR MEDICAL ASSISTANCE HERETOFORE OR HEREAFTER FURNISHED, IMPOSED BY LAW AND NOT SHOWN BY THE PUBLIC RECORDS. **(NON SURVEY RELATED ITEM)**

ITEM 8) ANY SERVICE, INSTALLATION, CONNECTION, MAINTENANCE, CONSTRUCTION, TAP OR REIMBURSEMENT CHARGES/COSTS FOR SEWER, WATER, GARBAGE OR ELECTRICITY. **(NON SURVEY RELATED ITEM)**

ITEMS 9–13) ITEMS REGARDING TAXES AND/OR FISCAL RESPONSIBILITY. **(NON SURVEY RELATED ITEMS)**

ITEM 14) THE LAND DESCRIBED IN THIS COMMITMENT APPEARS TO BE RESIDENTIAL IN NATURE AND MAY BE SUBJECT TO THE PROVISIONS OF R.C.W. 6.13.010, ET SEQ. (HOMESTEAD STATUTE) IF THE LAND IS OCCUPIED AS A PRIMARY RESIDENCE. IF THE LAND IS OCCUPIED AS A PRIMARY RESIDENCE, R.C.W. 6.13.060 REQUIRES THAT ALL DOCUMENTS CONVEYING OR ENCUMBERING THE LAND MUST BE EXECUTED BY EACH SPOUSE OR DOMESTIC PARTNER, INDIVIDUALLY. ALTERNATIVELY, THE COMPANY WILL ACCEPT A DEED IDENTIFYING THE NON-VESTED SPOUSE OCCUPYING THE PROPERTY AS THE GRANTOR AND THE VESTED SPOUSE AS THE GRANTEE. IN THE EVENT THAT THE COMPANY RECEIVES DOCUMENTS TO INSURE THAT ARE NOT EXECUTED AS REQUIRED, THE COMPANY MAY BE UNABLE TO RECORD OR TO INSURE THE TRANSACTION. PLEASE CONTACT YOUR TITLE OFFICER IF YOU HAVE ANY QUESTIONS. **(NON SURVEY RELATED ITEM)**

ITEM 15) ACCORDING TO THE APPLICATION FOR TITLE INSURANCE, TITLE IS TO VEST IN TYLER LITZENBERGER. IF SAD PARTY(IES) IS/ARE MARRIED AND WE ARE TO INSURE TITLE AS SUCH, FREE OF ANY INTEREST OF THE SPOUSE(S), WE WILL REQUIRE A DEED OF CONVEYANCE FROM THE NON-VESTING SPOUSE(S). **(NON SURVEY RELATED ITEM)**


ITEM 16) WAIVER AND RELINQUISHMENT OF ALL CLAIMS FOR DAMAGE ARISING FROM THE ESTABLISHMENT OF A PUBLIC ROAD AS SET FORTH BY INSTRUMENT RECORDED UNDER RECORDING NUMBER 337244. **(NON SURVEY RELATED ITEM)**

ITEM 17) CONDITIONS, NOTES, EASEMENTS, PROVISIONS, ENCROACHMENTS AND/OR OTHER MATTERS CONTAINED AND/OR DELINEATED ON THE FACE OF THE SURVEY NO. 3204, RECORDED IN VOLUME 33

EXISTING CONDITIONS
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 25' 50' 100'
SCALE: 1"=50'

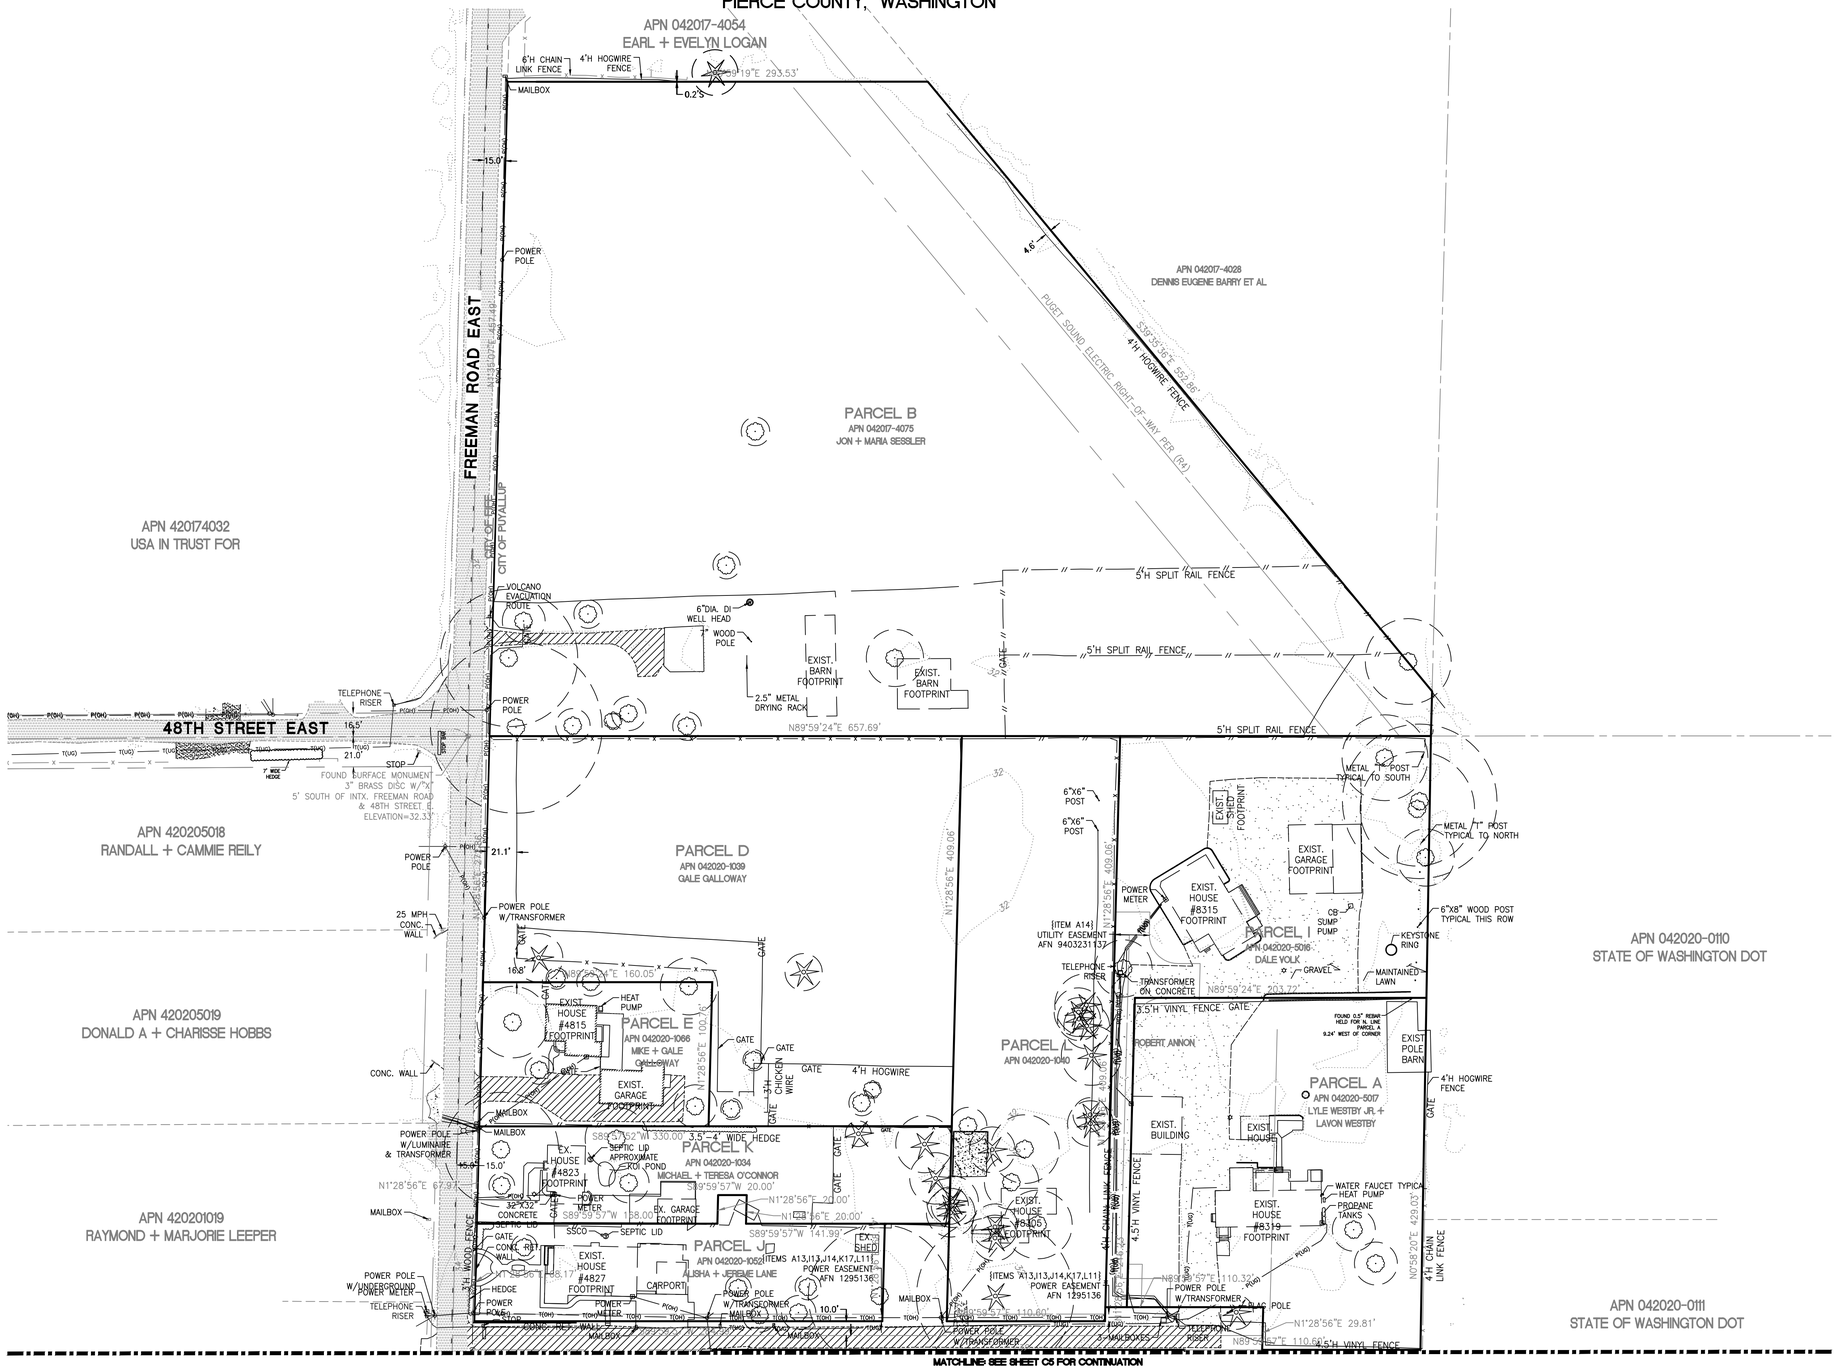

LEGEND

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- SURVEY MONUMENT (AS NOTED)
- SECTION CORNER (AS NOTED)
- SET REBAR/CAP (LS#45789 OR #41282)
- FOUND REBAR/CAP (AS NOTED)
- SET 2"X2" HUB/TACK LINE STAKE
- MAG/WASHER OR LEAD/TACK (AS NOTED)
- LUMINAIRE (LUM.)
- YARD LIGHT
- ORNAMENTAL LIGHT
- POWER METER (PM)
- POWER POLE (PP)
- JUNCTION BOX (AS NOTED)
- TELEPHONE MANHOLE (TM)
- TELEPHONE RISER (TR)
- CATCH BASIN (CB)
- STORM MANHOLE (SDMH)
- SANITARY SEWER MANHOLE (SSMH)
- GAS METER (GM)
- GAS VALVE (GV)
- WATER VALVE (WV)
- FAUCET
- FIRE HYDRANT(FH)
- WATER MANHOLE
- WATER METER (WM)
- WELL
- SIGN
- IRRIGATION VALVE (IV)
- DIRECTIONAL ARROW
- MAILBOX (MB)
- CHAIN LINK FENCE
- WOOD FENCE
- HOGWIRE FENCE
- VINYL FENCE
- WATER LINE
- GAS LINE
- T(XX) TELEPHONE LINE (OH) OR (UG)
- P(XX) POWER LINE (OH) OR (UG)
- SD STORM LINE
- SS SEWER LINE
- ROCKERY
- KEYSTONE WALL
- DECIDUOUS TREE
- CONIFEROUS TREE
- TREE DRIPLINE
- CONCRETE
- GRAVEL/SAND (AS NOTED)
- ASPHALT
- BUILDING LINE
- ROCK
- MATCH LINE

ABBREVIATIONS

(R#)	REFERENCE SURVEYS
(OH)	OVERHEAD
(UG)	UNDERGROUND
(TYP)	TYPICAL
(C)	CALCULATED
(M)	MEASURED
(GIS)	GEOGRAPHICAL INFORMATION SYSTEMS
(REF)	PER REFERENCE INFORMATION
(H)	HIGH
(IV)	IRRIGATION VALVE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **EXISTING CONDITIONS**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

Scale: Horizontal 1"=50' Vertical N/A
Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585
Sheet C4 of 48

P:\21000s\21585\engineering\SEPA SET\21585-EX.dwg 12/5/2024 9:41 AM DCASEY

EXISTING CONDITIONS

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

MATCHLINE SEE SHEET C4 FOR CONTINUATION

N

0 25' 50' 100'

SCALE: 1"=50'

LEGEND

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- SURVEY MONUMENT (AS NOTED)
- SECTION CORNER (AS NOTED)
- SET REBAR/CAP (LS#45789 OR #41282)
- FOUND REBAR/CAP (AS NOTED)
- SET 2"X2" HUB/TACK LINE STAKE
- MAG/WASHER OR LEAD/TACK (AS NOTED)
- LUMINAIRE (LUM.)
- YARD LIGHT
- ORNAMENTAL LIGHT
- POWER METER (PM)
- POWER POLE (PP)
- JUNCTION BOX (AS NOTED)
- TELEPHONE MANHOLE (TM)
- TELEPHONE RISER (TR)
- CATCH BASIN (CB)
- STORM MANHOLE (SDMH)
- SANITARY SEWER MANHOLE (SSMH)
- GAS METER (GM)
- GAS VALVE (GV)
- WATER VALVE (WV)
- FAUCET
- FIRE HYDRANT(FH)
- WATER MANHOLE
- WATER METER (WM)
- WELL
- SIGN
- IRRIGATION VALVE (IV)
- DIRECTIONAL ARROW
- MAILBOX (MB)
- CHAIN LINK FENCE
- WOOD FENCE
- HOGWIRE FENCE
- VINYL FENCE
- WATER LINE
- GAS LINE
- TELEPHONE LINE (OH) OR (UG)
- POWER LINE (OH) OR (UG)
- STORM LINE
- SEWER LINE
- ROCKERY
- KEYSTONE WALL
- DECIDUOUS TREE
- CONIFEROUS TREE
- TREE DRIPLINE
- CONCRETE
- GRAVEL/SAND (AS NOTED)
- ASPHALT
- BUILDING LINE
- ROCK
- MATCH LINE

ABBREVIATIONS

(R#)	REFERENCE SURVEYS
(OH)	OVERHEAD
(UG)	UNDERGROUND
(TYP)	TYPICAL
(C)	CALCULATED
(M)	MEASURED
(GIS)	GEOGRAPHICAL INFORMATION SYSTEMS
(REF)	PER REFERENCE INFORMATION
(H)	HIGH
(IV)	IRRIGATION VALVE

APN 420201017
WILLIAM C + BECKY L WHIDBY

APN 420201057
VLADIMIR + DARYA POPOV

APN 420201030
GREGG H + DIANA L JONES

APN 420201084
TERRY + CHARLENE WORSWICK

APN 420201004
MICHAEL C BLODGETT

APN 420201035
VIRGILIO $ HUESCA SORIANO

APN 420205015
CARRELL VICTORIA SPECIAL NEEDS TRUST

APN 420201104
TERHUNE RAY INVESTMENTS LLC

APN 420201008
PUYALLUP TRIBE OF INDIANS

APN 042020-1032
CHARLES ALMONT JR.

APN 042020-0111
STATE OF
WASHINGTON DOT

APN 042020-5013
SCHENK
BUSINESS
PARK
LLC

APN 042020-5010
SCHENK BUSINESS PARK LLC

PARCEL F
APN 042020-1042
DANNY + WENDY
SHADLE

PARCEL C
APN 042020-1027
SAMUEL KEATON
(DOES NOT EXCEPT OUT
FREEMAN ROAD)

PARCEL M
APN 042020-1036
CRP/VDC FREEMAN
LOGISTICS OWNER LLC

PARCEL N
APN 042020-5004
CRP/VDC FREEMAN
LOGISTICS OWNER LLC

PARCEL G
APN 042020-1101
CRP/VDC FREEMAN
LOGISTICS OWNER LLC

PARCEL H
APN 042020-5003
RICHARD JOHNSON

PARCEL G-ESMT

NO TITLE PROVIDED
APN 042020-1045
DENNIS GREER

50TH STREET EAST

FREEMAN ROAD EAST

19TH AVE NW (PRIVATE)

FREEMAN ROAD
NOT EXCLUDED FROM
PARCEL "C"
LEGAL DESCRIPTION

CITY OF PUYALLUP

FOUND 1" IP
S07°56'10"W 2.5'
OF NW CORNER
PARCEL F

FOUND 0.5" REBAR
AT NE CORNER
PARCEL F

FOUND 1" IP
S70°59'23"E, 1.39'
OF CALC

FOUND 1/2" RBC
GARMAN #41301
S12°10'11"W 0.49'
OF CALC

FOUND 1/2" RBC
LEROYS #12944
S23°28'41"W, 0.31'
OF CALC

FOUND 1/2" RBC
LEROYS #12944
S02°31'23"W, 1.87'
OF CALC

FOUND 1/2" RBC
THOMAS #16090
S65°04'19"E 0.35'
OF CORNER

FOUND 1/2" RBC
ILLEGIBLE
S57°15'55"E 0.65'
OF CORNER

APPROXIMATE LOCATION
CAPPED VERTICAL METAL RIPE
ADS NOTES: NO TRACE OF
NEIGHBORHOOD
WATCH

FOUND SURFACE MONUMENT
3" BRASS DISC W/"X"
CENTERLINE FREEMAN ROAD
NORTH OF 52ND STREET E.
ELEVATION=36.49'

60.0' ROAD AND UTILITIES EASEMENT AFN. 3000857

N88°31'00"E 279.00'
S89°59'09"E 279.09'
S89°59'31"E 279.09'
S89°59'57"E 330.00'
N89°59'57"E 663.04'
S89°59'57"W 663.71'
N1°28'56"E 676.08'
N1°28'56"E 676.13'
N1°28'56"E 172.00'
N0°58'20"E 75.01'

CB-24"
25" RIM=33.84'
IE 12" CMP N=30.34'
BOTTOM STR.=29.04'

CB STD. GRT.
14X20" RIM=31.37'
IE 8" PVC S=30.07'
IE 8" PVC W=30.17'
BOTTOM STR.=29.27'

CB STD. GRT.
18X24" RIM=32.11'
IE 12" ADS S=29.36'
IE 12" ADS W=29.71'
IE 12" ADS E=29.61'
BOTTOM STR.=27.91'

CB STD. GRT.
18X24" RIM=31.82'
IE 12" ADS N=29.92'
IE 12" ADS E=30.02'
BOTTOM STR.=28.47'

MATCHLINE SEE SHEET C6 FOR CONTINUATION

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **EXISTING CONDITIONS**

FOR
FREEMAN LOGISTICS

For:
VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

Scale: Horizontal 1"=50' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C5 of 48

P:\21000s\21585\engineering\SEPA SET\21585-EX.dwg 12/5/2024 9:41 AM DCASEY

EXISTING CONDITIONS

OF


FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 25' 50' 100'

SCALE: 1"=50'

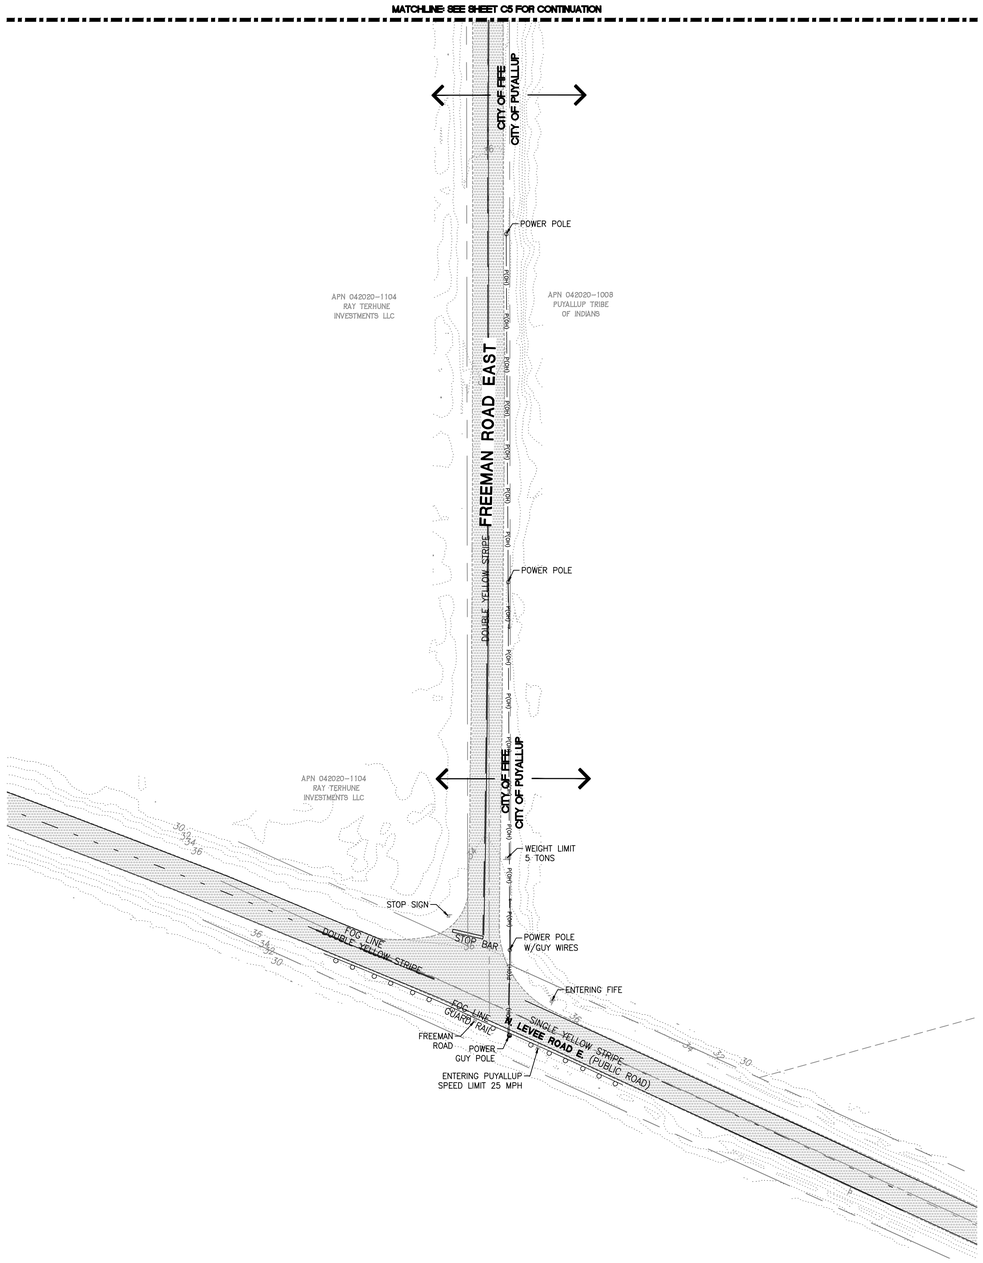

LEGEND

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- SURVEY MONUMENT (AS NOTED)
- SECTION CORNER (AS NOTED)
- SET REBAR/CAP (LS#45789 OR #41282)
- FOUND REBAR/CAP (AS NOTED)
- SET 2"X2" HUB/TACK LINE STAKE
- MAG/WASHER OR LEAD/TACK (AS NOTED)
- LUMINAIRE (LUM.)
- YARD LIGHT
- ORNAMENTAL LIGHT
- POWER METER (PM)
- POWER POLE (PP)
- JUNCTION BOX (AS NOTED)
- TELEPHONE MANHOLE (TM)
- TELEPHONE RISER (TR)
- CATCH BASIN (CB)
- STORM MANHOLE (SDMH)
- SANITARY SEWER MANHOLE (SSMH)
- GAS METER (GM)
- GAS VALVE (GV)
- WATER VALVE (WV)
- FAUCET
- FIRE HYDRANT(FH)
- WATER MANHOLE
- WATER METER (WM)
- WELL
- SIGN
- IRRIGATION VALVE (IV)
- DIRECTIONAL ARROW
- MAILBOX (MB)
- CHAIN LINK FENCE
- WOOD FENCE
- HOGWIRE FENCE
- VINYL FENCE
- WATER LINE
- GAS LINE
- T(XX) TELEPHONE LINE (OH) OR (UG)
- P(XX) POWER LINE (OH) OR (UG)
- SD STORM LINE
- SS SEWER LINE
- ROCKERY
- KEYSTONE WALL
- DECIDUOUS TREE
- CONIFEROUS TREE
- TREE DRIPLINE
- CONCRETE
- GRAVEL/SAND (AS NOTED)
- ASPHALT
- BUILDING LINE
- ROCK
- MATCH LINE

ABBREVIATIONS

(R#)	REFERENCE SURVEYS
(OH)	OVERHEAD
(UG)	UNDERGROUND
(TYP)	TYPICAL
(C)	CALCULATED
(M)	MEASURED
(GIS)	GEOGRAPHICAL INFORMATION SYSTEMS
(REF)	PER REFERENCE INFORMATION
(H)	HIGH
(IV)	IRRIGATION VALVE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **EXISTING CONDITIONS**

FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Scale: Horizontal 1"=50' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Job Number 21585


Sheet C6 of 48

P:\21000s\21585\engineering\SEPA SET\21585-EX.dwg 12/5/2024 9:41 AM DCASEY

PRELIMINARY STORM DRAINAGE OVERALL PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 100' 200' 400'
SCALE: 1"=200'

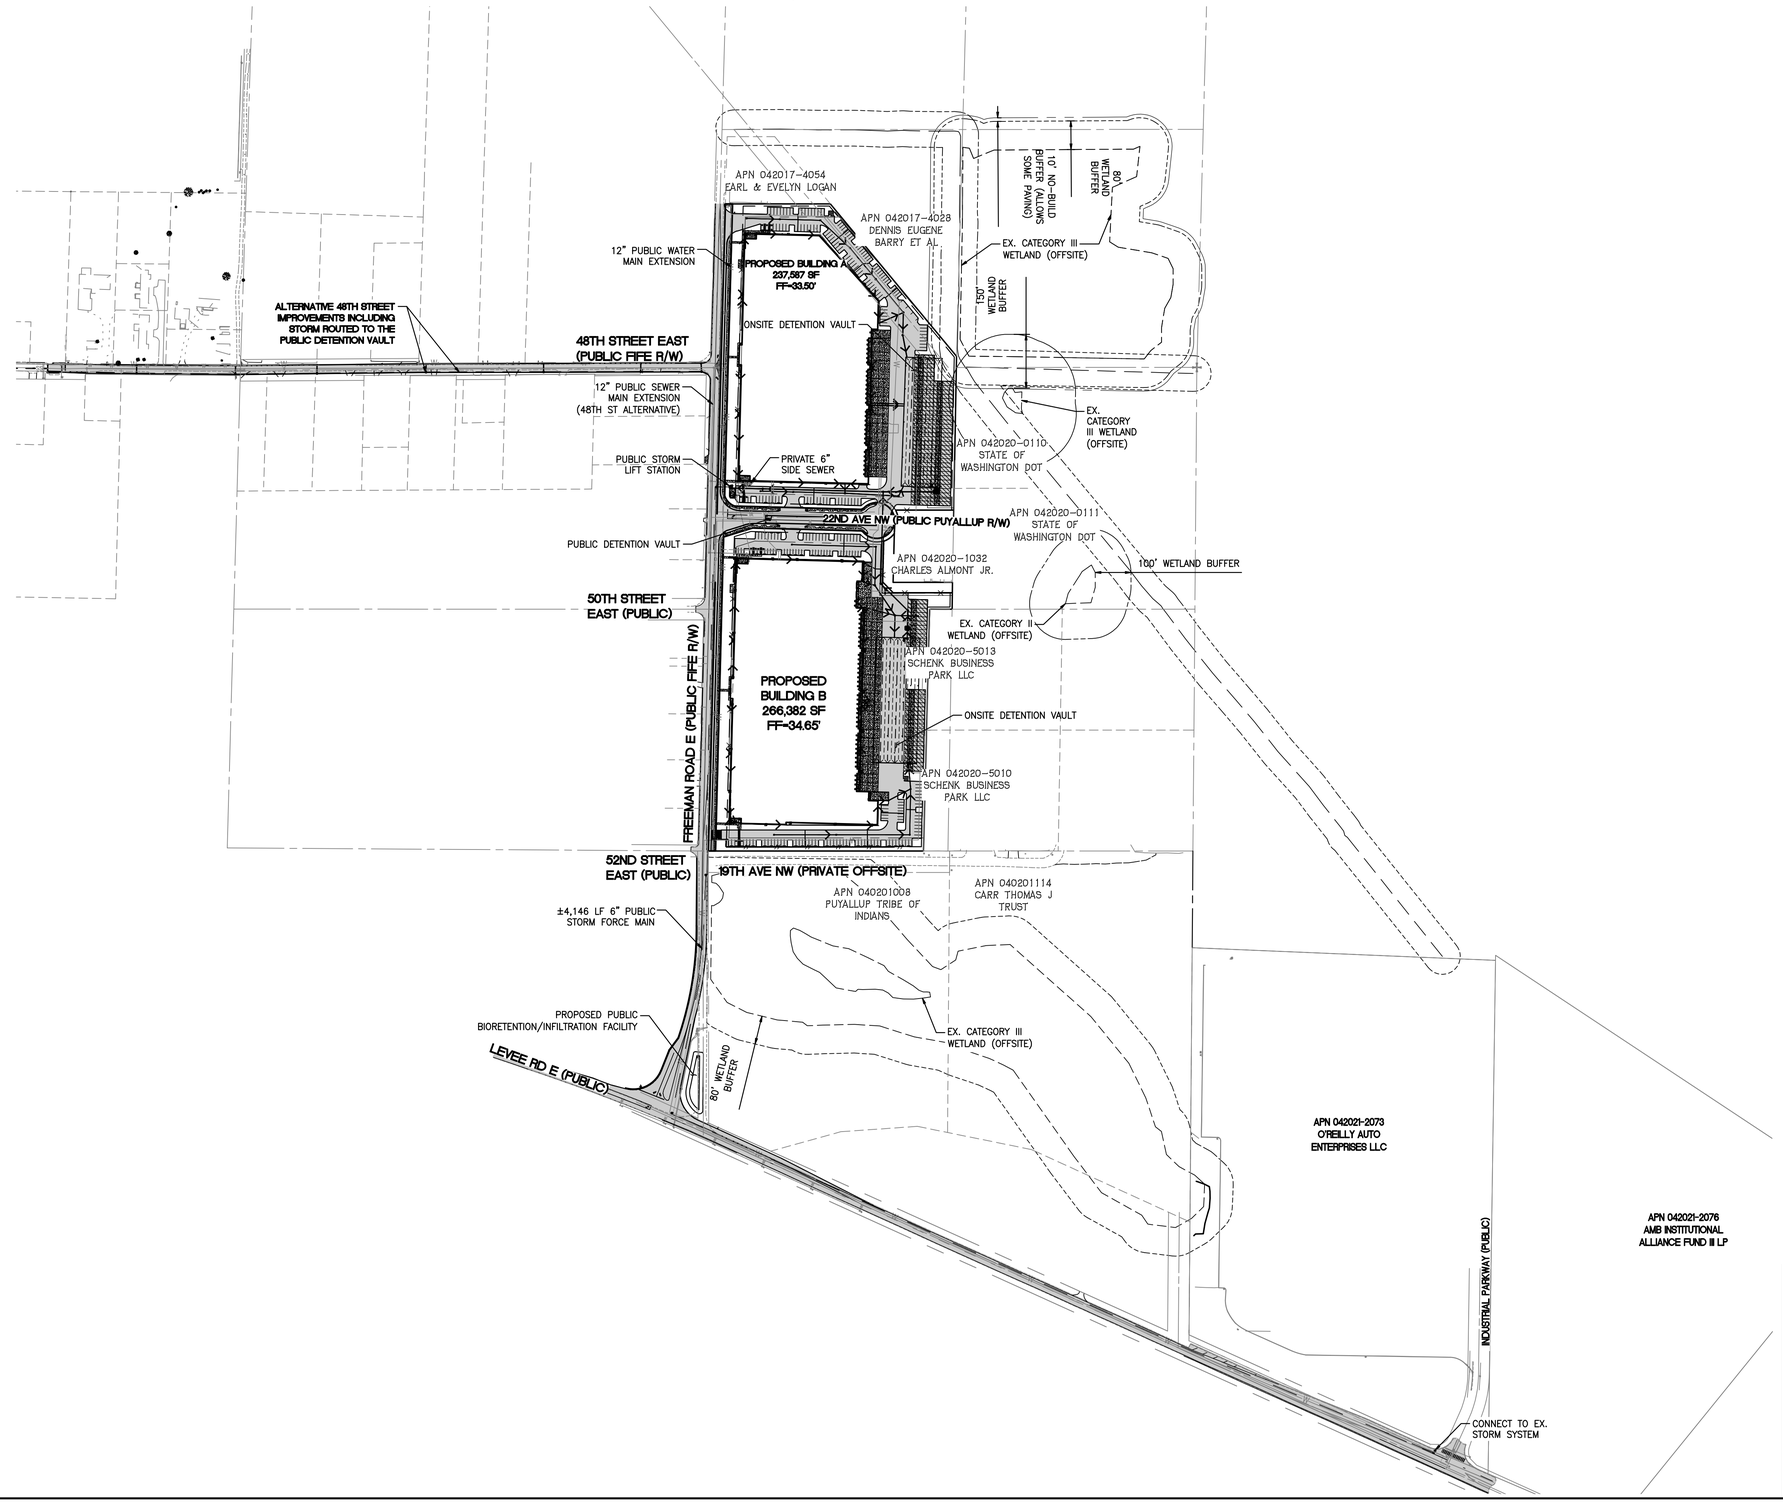

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title:
PRELIMINARY STORM DRAINAGE OVERALL PLAN
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCCASEY
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=200' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Job Number 21585

Sheet C7 of 48


P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 7/16/2025 11:11 AM DCASEY

PRELIMINARY GRADING AND DRAINAGE PLAN

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

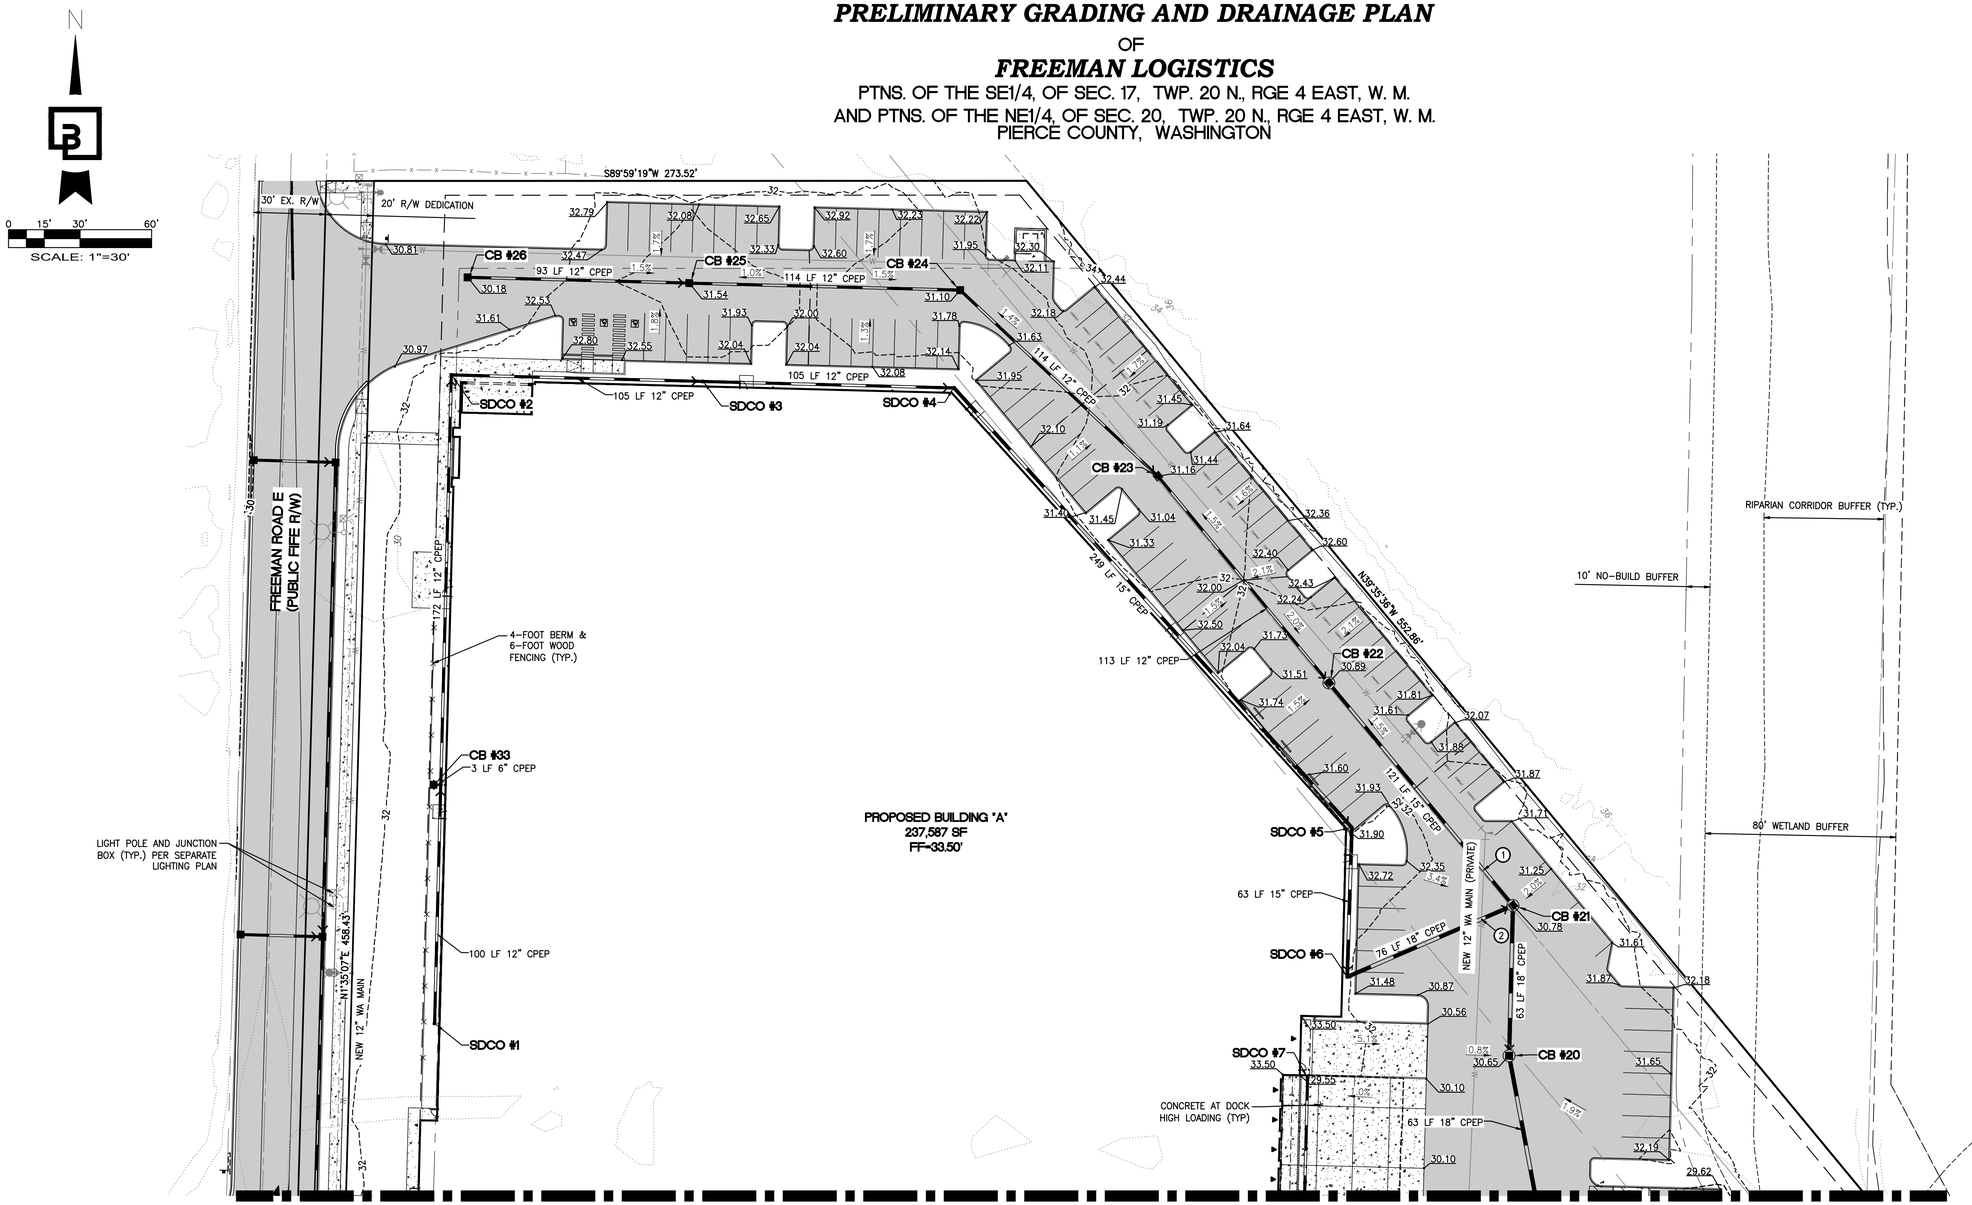

MATCHLINE- SEE SHEET C9 FOR CONTINUATION

CATCH BASINS
CB #20, TYPE 2-48" W/STANDARD GRATE RIM=30.65 IE=24.03 (18" N) IE=24.03 (18" S)
CB #21, TYPE 2-48" W/STANDARD GRATE RIM=30.78 IE=24.78 (15" NW) IE=24.53 (18" SW) IE=24.53 (18" S)
CB #22, TYPE 2-48" W/STANDARD GRATE RIM=30.89 IE=25.74 (12" NW) IE=25.49 (15" SE)
CB #23, TYPE 1, W/STANDARD GRATE RIM=31.16 IE=26.38 (12" NW) IE=26.38 (12" SE)
CB #24, TYPE 1, W/STANDARD GRATE RIM=31.10 IE=26.95 (12" W) IE=26.95 (12" SE)
CB #25, TYPE 1, W/STANDARD GRATE RIM=31.54 IE=27.52 (12" W) IE=27.52 (12" E)
CB #26, TYPE 1, W/STANDARD GRATE RIM=30.18 IE=27.98 (12" E)
CB #33, TYPE 1, W/STANDARD GRATE RIM=33.18 IE=30.90 (6" E)
SDCO #1, 8" SDCO RIM=33.40 IE=31.00 (12" N)
SDCO #2, 8" SDCO RIM=33.22 IE=28.98 (12" S) IE=28.98 (12" E)
SDCO #3, 8" SDCO RIM=32.21 IE=28.19 (12" W) IE=28.19 (12" E)
SDCO #4, 8" SDCO RIM=32.61 IE=27.41 (12" W) IE=27.16 (15" SE)
SDCO #5, 8" SDCO RIM=31.89 IE=25.56 (15" NW) IE=25.56 (15" S)
SDCO #6, 8" SDCO RIM=32.28 IE=25.09 (15" N) IE=24.84 (18" NE)
SDCO #7, 8" SDCO RIM=29.58 IE=27.20 (12" S)
SDCO #37, 8" SDCO RIM=33.38 IE=30.26 (12" S) IE=30.76 (6" W) IE=30.26 (12" N)

UTILITY CROSSING TABLE					
#	BOTTOM UTILITY	TOP	TOP UTILITY	BOTTOM	CLEAR (FT)
1	15" STORM	26.00	12" WATER	27.00	1.00
2	18" STORM	26.00	12" WATER	27.00	1.00

UTILITY CROSSING NOTE:

CONTRACTOR SHALL MAINTAIN MINIMUM VERTICAL SEPARATION BETWEEN UTILITIES AS REQUIRED BY JURISDICTIONS HAVING AUTHORITY. CONTRACTOR TO VERIFY SEPARATION REQUIREMENTS PRIOR TO CONSTRUCTION AND NOTIFY ENGINEER OF ANY DISCREPANCIES.

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY GRADING AND DRAINAGE PLAN**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCAFEE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=30' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C8 of 48


P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 7/16/2025 11:11 AM DCASEY

PRELIMINARY GRADING AND DRAINAGE PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 15' 30' 60'
SCALE: 1"=30'

MATCHLINE- SEE SHEET C8 FOR CONTINUATION

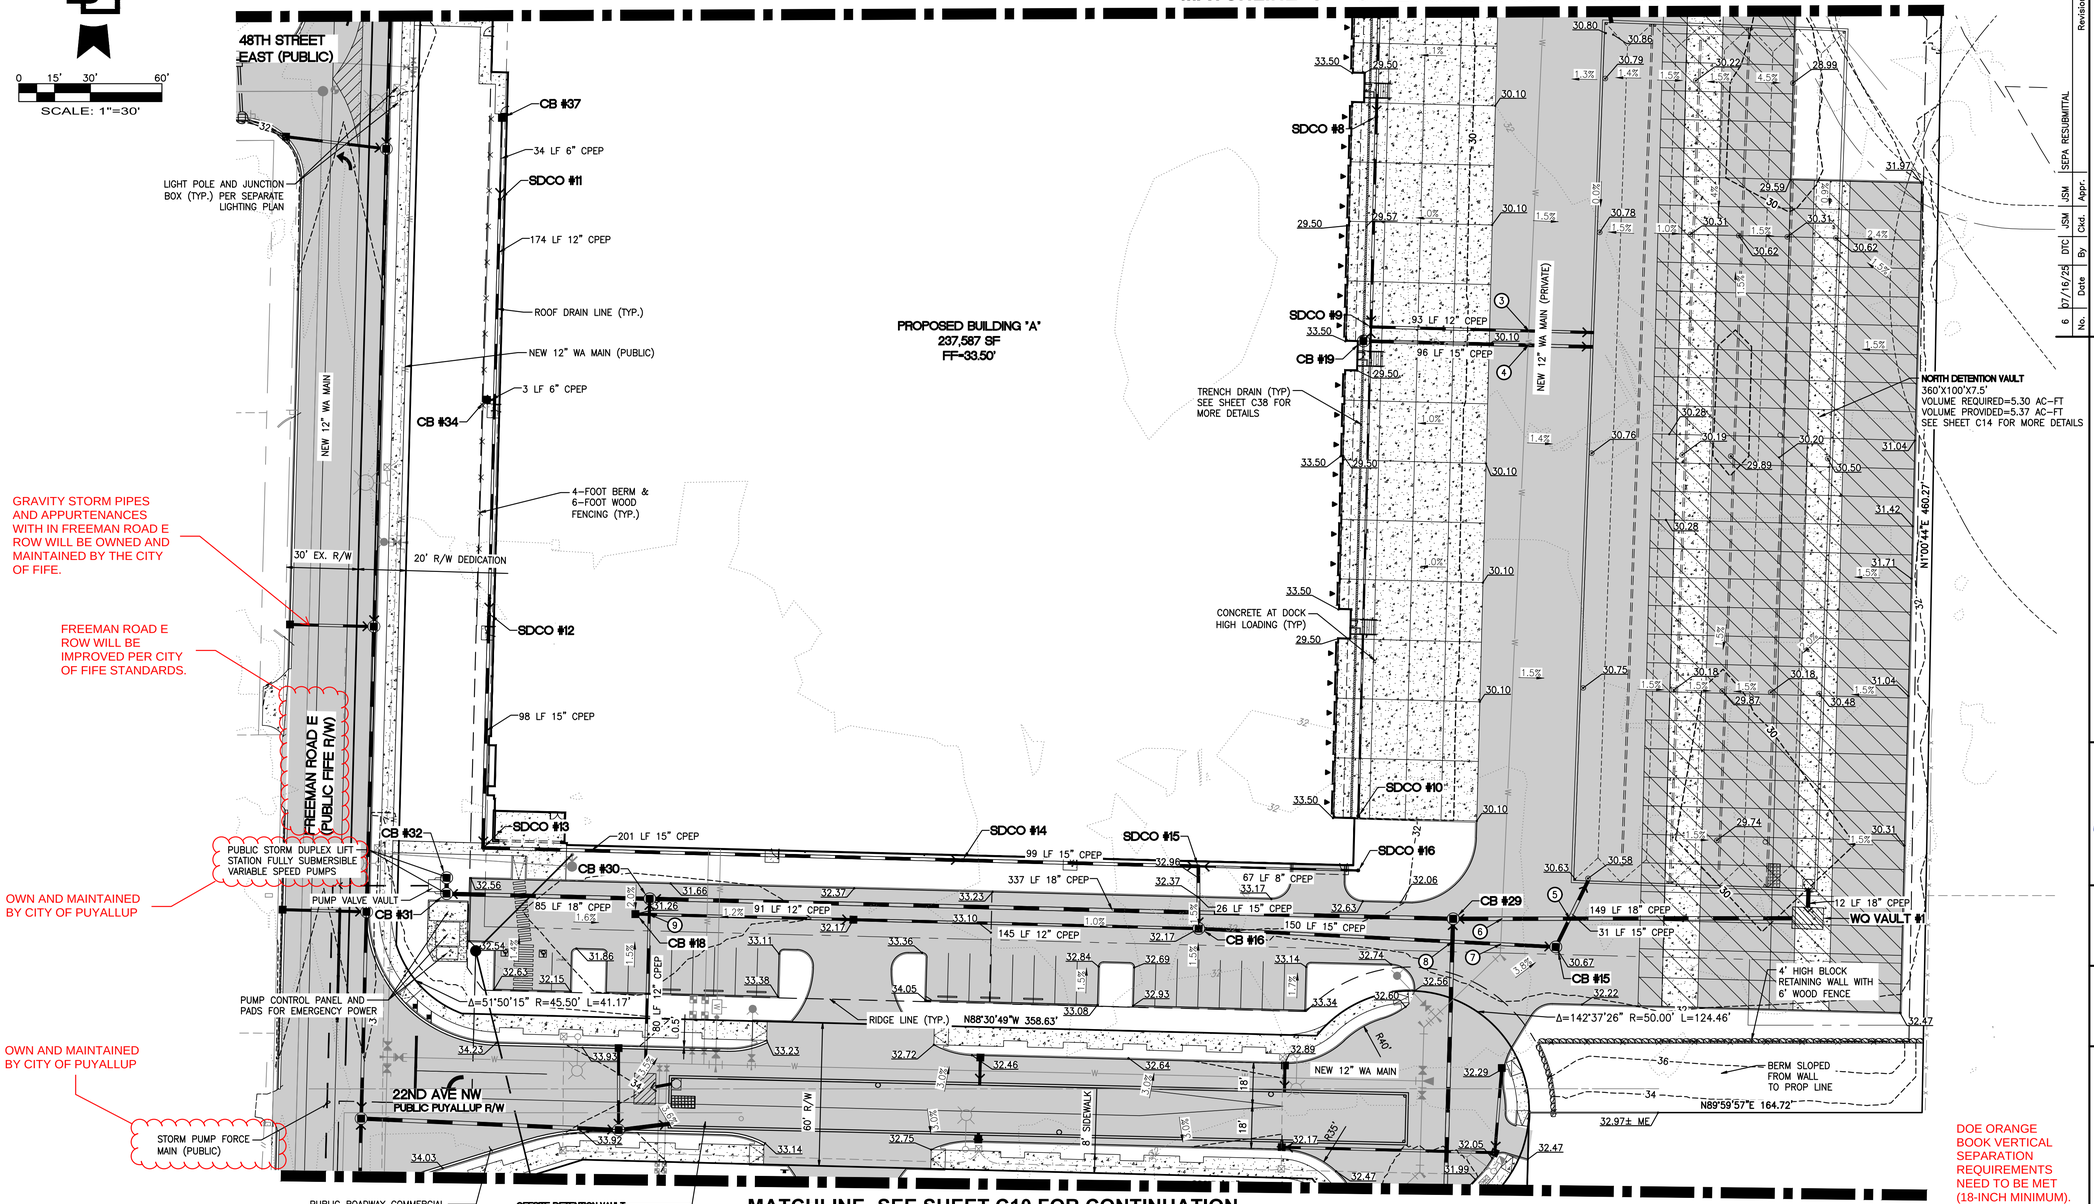

MATCHLINE- SEE SHEET C10 FOR CONTINUATION

CATCH BASINS
CB #15, TYPE 2-48", W/STANDARD GRATE RIM=30.67 IE=24.96 (15" W) IE=24.96 (15" NE)
CB #16, TYPE 2-48" W/STANDARD GRATE RIM=32.17 IE=27.22 (12" W) IE=26.97 (15" N) IE=26.97 (15" E)
CB #17, TYPE 1, W/STANDARD GRATE RIM=32.17 IE=27.94 (12" W) IE=27.94 (12" E)
CB #18, TYPE 1, W/STANDARD GRATE RIM=31.26 IE=28.40 (12" E)
CB #19, TYPE 2-48" W/STANDARD GRATE RIM=29.52 IE=24.00 (15" E)
CB #29, TYPE 2-48" W/SOLID LOCKING LID RIM=31.21 IE=17.18 (18" S) IE=17.18 (18" E) IE=17.18 (18" W)
CB #30, TYPE 2-48", W/STANDARD GRATE RIM=31.45 IE=14.92 (18" E) IE=15.38 (12" S) IE=14.92 (18" W)
CB #31, TYPE 2-54" W/SOLID LOCKING LID RIM=33.15 IE=12.99 (18" E) IE=12.99 (18" N)
CB #32, TYPE 2-54" W/SOLID LOCKING LID RIM=33.15 IE=12.99 (18" S)
CB #34, TYPE 1, W/STANDARD GRATE RIM=33.42 IE=31.33 (6" E)
CB #37, TYPE 1, W/STANDARD GRATE RIM=33.46 IE=31.75 (6" S)
SDCO #8, 8" SDCO RIM=29.57 IE=26.46 (12" N) IE=26.46 (12" S)
SDCO #9, 8" SDCO RIM=29.57 IE=26.08 (8" S) IE=25.75 (12" N) IE=25.75 (12" E)
SDCO #10, 8" SDCO RIM=29.59 IE=27.20 (8" N)
SDCO #11, 8" SDCO RIM=33.40 IE=31.50 (6" N) IE=31.00 (12" S)
SDCO #12, 8" SDCO RIM=33.50 IE=30.00 (12" N) IE=29.75 (15" S)
SDCO #13, 8" SDCO RIM=33.26 IE=29.17 (15" N) IE=29.17 (15" E)
SDCO #14, 8" SDCO RIM=33.36 IE=27.98 (15" W) IE=27.98 (15" E)
SDCO #15, 8" SDCO RIM=33.33 IE=27.39 (15" W) IE=27.97 (8" E) IE=27.39 (15" S)
SDCO #16, 8" SDCO RIM=33.33 IE=29.00 (8" W)
WQ VAULT #1, 6'X12' VAULT RIM=30.19 IE=20.29 (18" N) IE=18.12 (18" W)

UTILITY CROSSING TABLE

#	BOTTOM UTILITY	TOP	TOP UTILITY	BOTTOM	CLEAR (FT)
3	12" STORM	26.25	12" WATER	27.25	1.00
4	15" STORM	26.25	12" WATER	27.25	1.00
5	18" STORM	20.00	15" STORM	24.90	4.90
6	18" STORM	19.80	12" WATER	26.50	6.70
7	15" STORM	26.33	12" WATER	27.33	1.00
8	18" STORM	18.75	15" STORM	26.40	7.65
9	12" STORM	16.40	12" STORM	24.30	7.90

UTILITY CROSSING NOTE:
CONTRACTOR SHALL MAINTAIN MINIMUM VERTICAL SEPARATION BETWEEN UTILITIES AS REQUIRED BY JURISDICTIONS HAVING AUTHORITY. CONTRACTOR TO VERIFY SEPARATION REQUIREMENTS PRIOR TO CONSTRUCTION AND NOTIFY ENGINEER OF ANY DISCREPANCIES.

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY GRADING AND DRAINAGE PLAN**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCREE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=30' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C9 of 48


P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 7/16/2025 11:11 AM DCASEY

PRELIMINARY GRADING AND DRAINAGE PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 15' 30' 60'
SCALE: 1"=30'

MATCHLINE- SEE SHEET C9FOR CONTINUATION

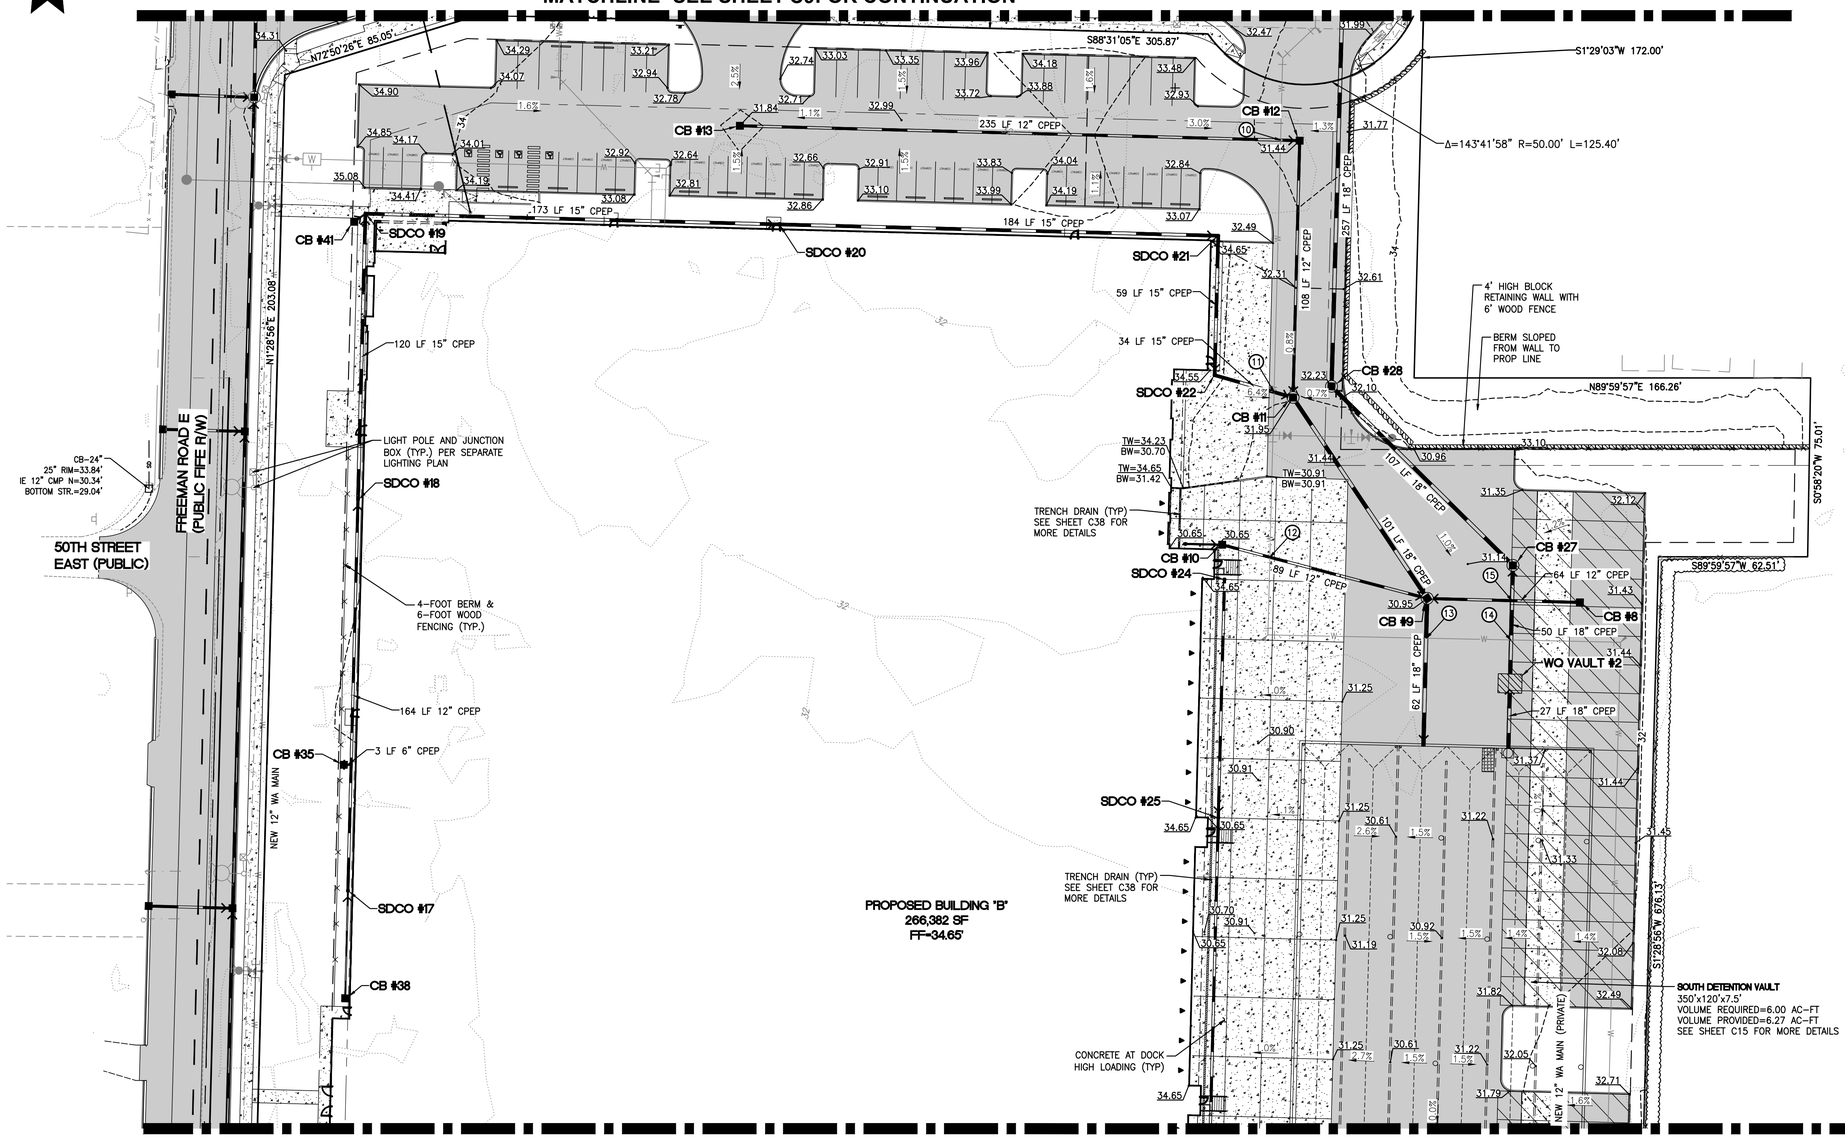

MATCHLINE- SEE SHEET C11 FOR CONTINUATION

CATCH BASINS
CB #8, TYPE 1, W/STANDARD GRATE RIM=31.04 IE=26.85 (12" W)
CB #9, TYPE 2-54" W/STANDARD GRATE RIM=30.95 IE=25.37 (18" NW) IE=25.98 (12" W) IE=26.06 (12" E) IE=25.37 (18" S)
CB #10, TYPE 1, W/STANDARD GRATE RIM=30.69 IE=27.98 (8" W) IE=27.65 (12" E)
CB #11, TYPE 2-48" W/STANDARD GRATE RIM=31.95 IE=26.48 (12" N) IE=26.23 (15" W) IE=25.98 (18" SE)
CB #12, TYPE 1, W/STANDARD GRATE RIM=31.44 IE=27.04 (12" W) IE=27.04 (12" S)
CB #13, TYPE 1, W/STANDARD GRATE RIM=31.84 IE=28.26 (12" E)
CB #27, TYPE 2-48" W/SOLID LOCKING LID RIM=31.43 IE=18.65 (18" S) IE=18.65 (18" NW)
CB #28, TYPE 2-48" W/SOLID LOCKING LID RIM=32.23 IE=18.26 (18" SE) IE=18.26 (18" N)
CB #35, TYPE 1, W/STANDARD GRATE RIM=34.77 IE=31.33 (6" E)
CB #38, TYPE 1, W/STANDARD GRATE RIM=34.53 IE=32.33 (6" N)
CB #41, TYPE 1, W/STANDARD GRATE RIM=34.38 IE=31.00 (6" NE)
SDCO #17, 8" SDCO RIM=34.60 IE=32.05 (6" S) IE=31.55 (12" N)
SDCO #18, 8" SDCO RIM=34.48 IE=30.73 (12" S) IE=30.48 (15" N)
SDCO #19, 8" SDCO RIM=34.42 IE=29.87 (15" S) IE=30.62 (6" SW) IE=29.87 (15" E)
SDCO #20, 8" SDCO RIM=33.36 IE=28.56 (15" W) IE=28.56 (15" E)
SDCO #21, 8" SDCO RIM=33.62 IE=27.18 (15" W) IE=27.18 (15" S)
SDCO #22, 8" SDCO RIM=34.33 IE=26.74 (15" N) IE=26.74 (15" E)
SDCO #23, 8" SDCO RIM=30.65 IE=28.50 (8" E)
SDCO #24, 8" SDCO RIM=30.73 IE=28.30 (12" S)
SDCO #25, 8" SDCO RIM=30.70 IE=27.02 (12" N) IE=27.02 (12" S)
WQ VAULT #2, 6'X12' VAULT RIM=31.50 IE=21.07 (18" S) IE=18.90 (18" N)

UTILITY CROSSING TABLE

#	BOTTOM UTILITY	TOP	TOP UTILITY	BOTTOM	CLEAR (FT)
10	12" STORM	26.10	12" STORM	27.10	1.00
11	15" STORM	26.75	12" WATER	27.75	1.00
12	18" STORM	26.60	12" STORM	27.60	1.00
13	18" STORM	26.80	12" WATER	27.80	1.00
14	18" STORM	20.20	12" WATER	27.00	6.80
15	18" STORM	20.00	12" STORM	26.50	6.50

UTILITY CROSSING NOTE:
CONTRACTOR SHALL MAINTAIN MINIMUM VERTICAL SEPARATION BETWEEN UTILITIES AS REQUIRED BY JURISDICTIONS HAVING AUTHORITY. CONTRACTOR TO VERIFY SEPARATION REQUIREMENTS PRIOR TO CONSTRUCTION AND NOTIFY ENGINEER OF ANY DISCREPANCIES.

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title:
PRELIMINARY GRADING AND DRAINAGE PLAN
FOR
FREEMAN LOGISTICS

For:
VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=30' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C10 of 48


P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 7/16/2025 11:11 AM DCASEY

PRELIMINARY GRADING AND DRAINAGE PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 15' 30' 60'
SCALE: 1"=30'

MATCHLINE- SEE SHEET C10 FOR CONTINUATION

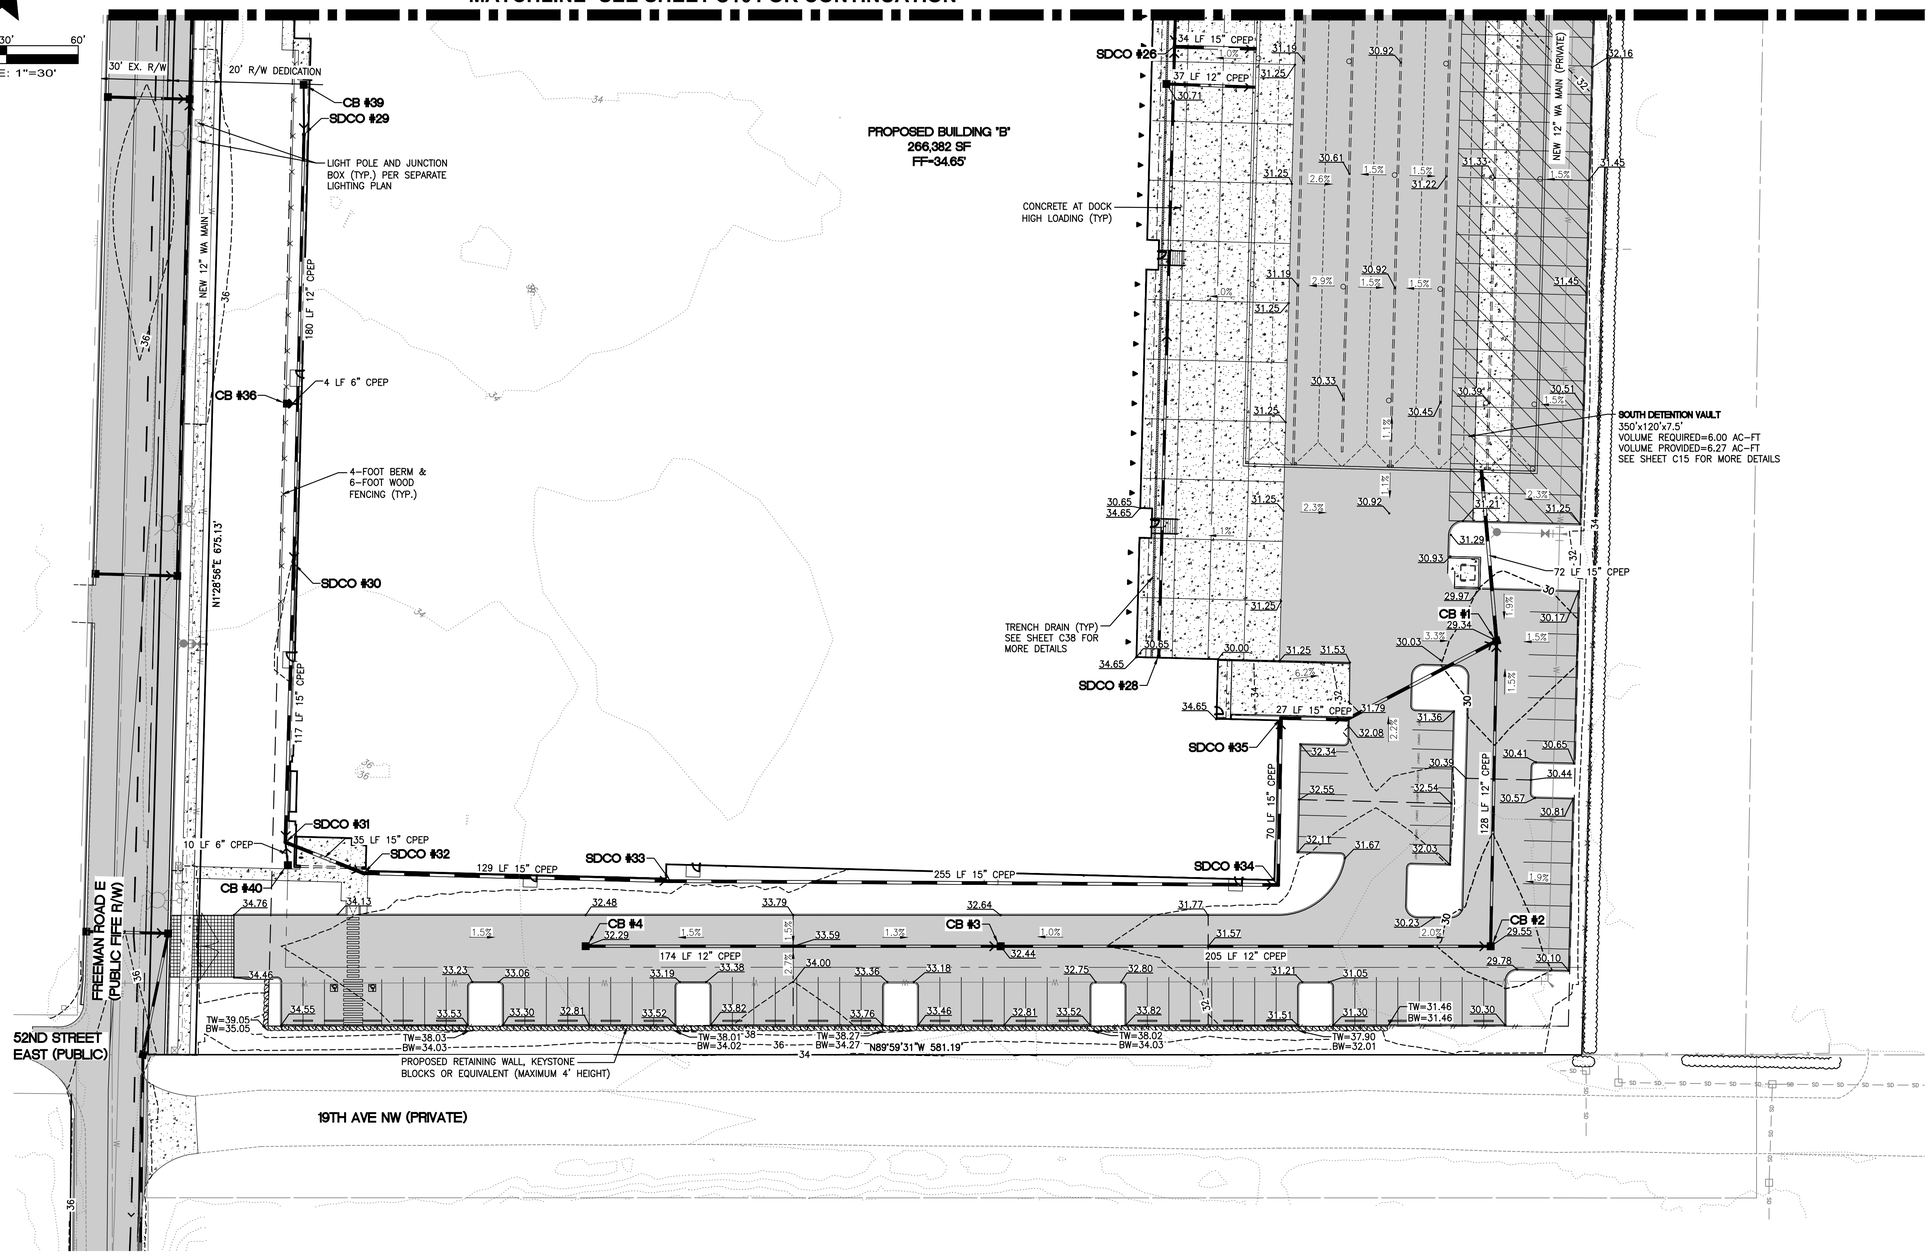

CATCH BASINS
CB #1, TYPE 1L, W/STANDARD GRATE RIM=29.34 IE=26.13 (12" S) IE=25.88 (15" SW) IE=25.88 (15" N)
CB #2, TYPE 1, W/STANDARD GRATE RIM=29.55 IE=27.80 (12" W) IE=27.80 (12" N)
CB #3, TYPE 1, W/STANDARD GRATE RIM=32.44 IE=28.83 (12" W) IE=28.83 (12" E)
CB #4, TYPE 1, W/STANDARD GRATE RIM=32.29 IE=29.70 (12" E)
CB #14, TYPE 1, W/STANDARD GRATE RIM=30.71 IE=27.70 (12" E)
CB #36, TYPE 1, W/STANDARD GRATE RIM=34.80 IE=31.33 (6" E)
CB #39, TYPE 1, W/STANDARD GRATE RIM=34.53 IE=32.63 (6" S)
CB #40, TYPE 1, W/STANDARD GRATE RIM=34.54 IE=31.00 (6" N)
SDCO #26, 8" SDCO RIM=30.74 IE=25.19 (12" S) IE=25.19 (12" N) IE=24.94 (15" E)
SDCO #27, 8" SDCO RIM=30.74 IE=26.63 (12" S) IE=26.63 (12" N)
SDCO #28, 8" SDCO RIM=30.47 IE=28.30 (12" N)
SDCO #29, 8" SDCO RIM=34.61 IE=32.50 (6" N) IE=32.00 (12" S)
SDCO #31, 8" SDCO RIM=34.77 IE=29.73 (15" N) IE=30.48 (6" S) IE=29.73 (15" E)
SDCO #32, 8" SDCO RIM=34.51 IE=29.50 (15" W) IE=29.50 (15" E)
SDCO #33, 8" SDCO RIM=34.44 IE=28.65 (15" W) IE=28.65 (15" E)
SDCO #34, 8" SDCO RIM=32.34 IE=26.98 (15" W) IE=26.98 (15" N)
SDCO #35, 8" SDCO RIM=33.03 IE=26.52 (15" S) IE=26.52 (15" E)
SDCO #36, 8" SDCO RIM=32.33 IE=26.37 (15" W) IE=26.37 (15" NE)

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY GRADING AND DRAINAGE PLAN**
FOR
FREEMAN LOGISTICS

For:
VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=30' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C11 of 48

P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 7/16/2025 11:11 AM DCASEY

PRELIMINARY DRAINAGE OUTLET PLAN


OF


FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 25' 50' 100'
SCALE: 1"=50'

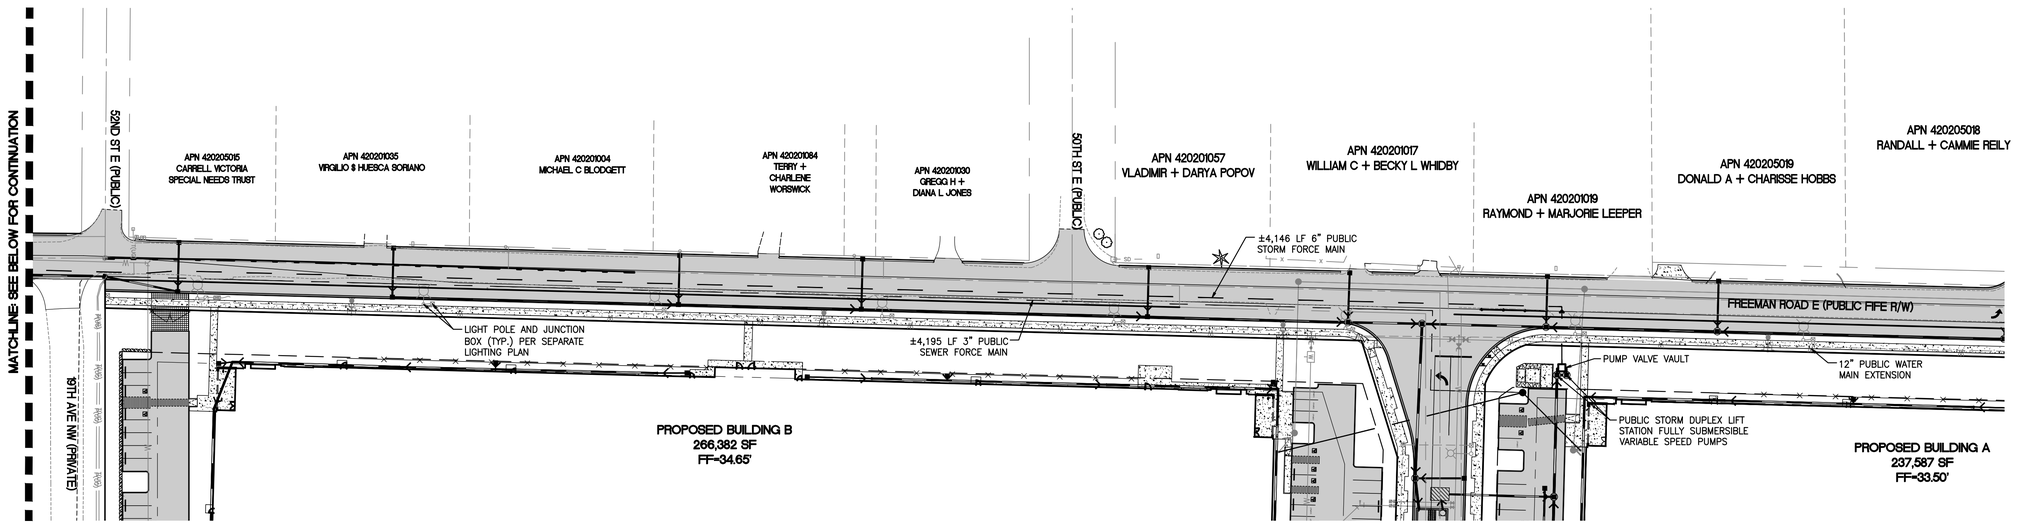

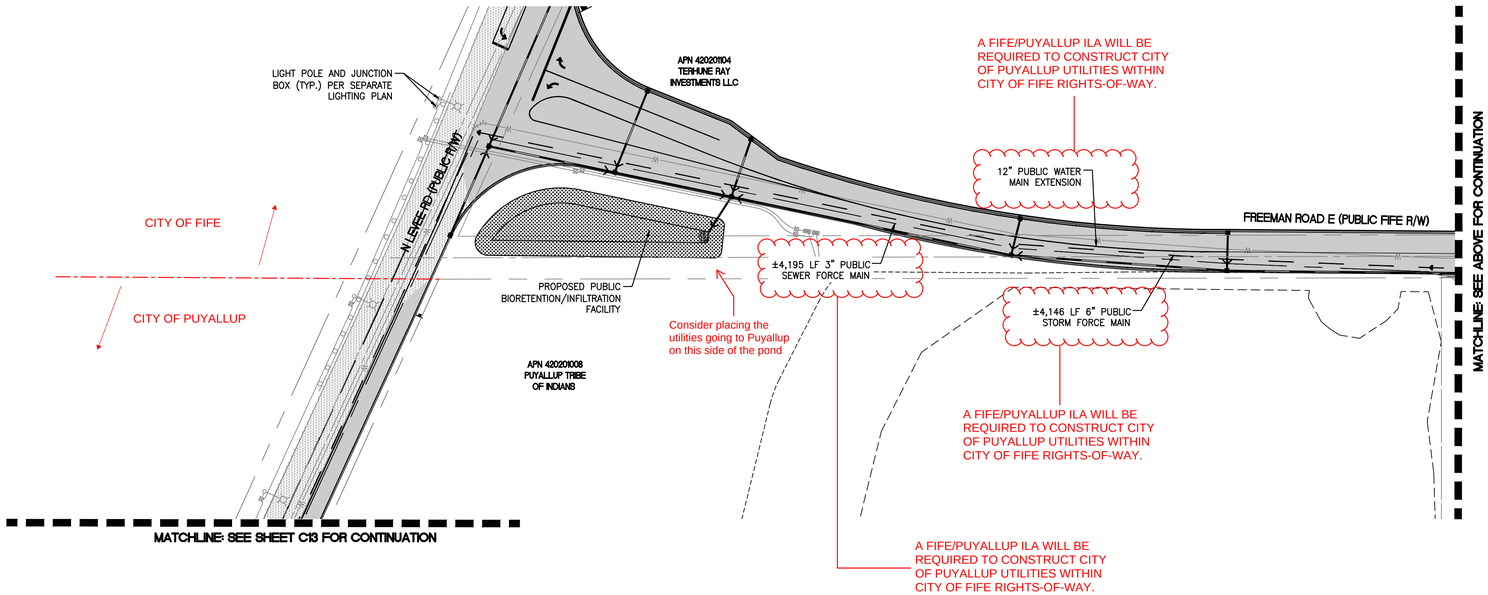

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY DRAINAGE OUTLET PLAN**

FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE
STATE OF WASHINGTON
54927
REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=50' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C12 of 48

P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 7/16/2025 11:11 AM DCASEY

ENGINEER'S REVIEW
- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY _____ DATE _____

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

PRELIMINARY DRAINAGE OUTLET PLAN


OF


FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 25' 50' 100'
SCALE: 1"=50'

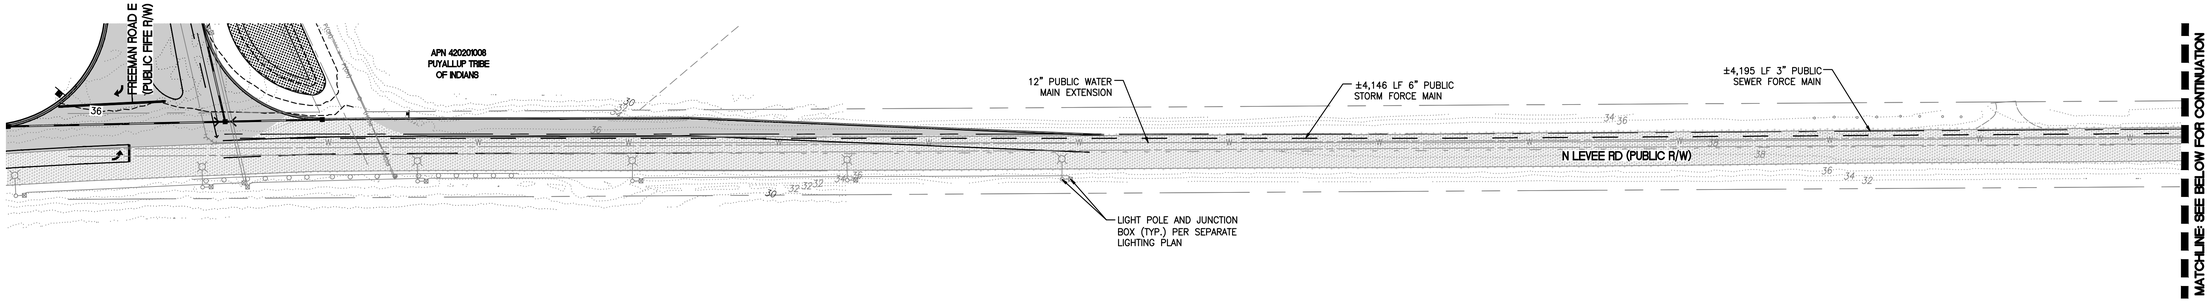

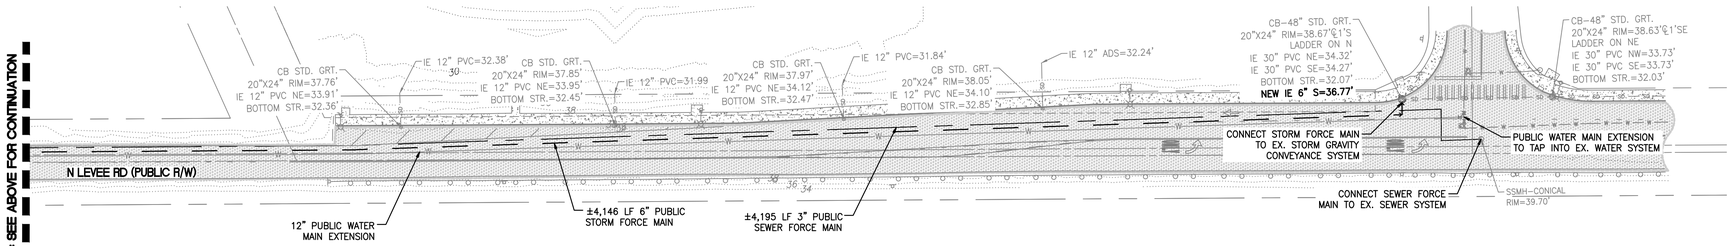

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY DRAINAGE OUTLET PLAN**

FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=50' Vertical N/A

Designed JSM. Drawn DTC. Checked JSM. Approved JSM. Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Job Number 21585

Sheet C13 of 48

P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 7/16/2025 11:11 AM DCASEY


PRELIMINARY DETENTION VAULT PLAN - NORTH

OF

FREEMAN LOGISTICS


PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

0 10' 20' 40'
SCALE: 1"=20'

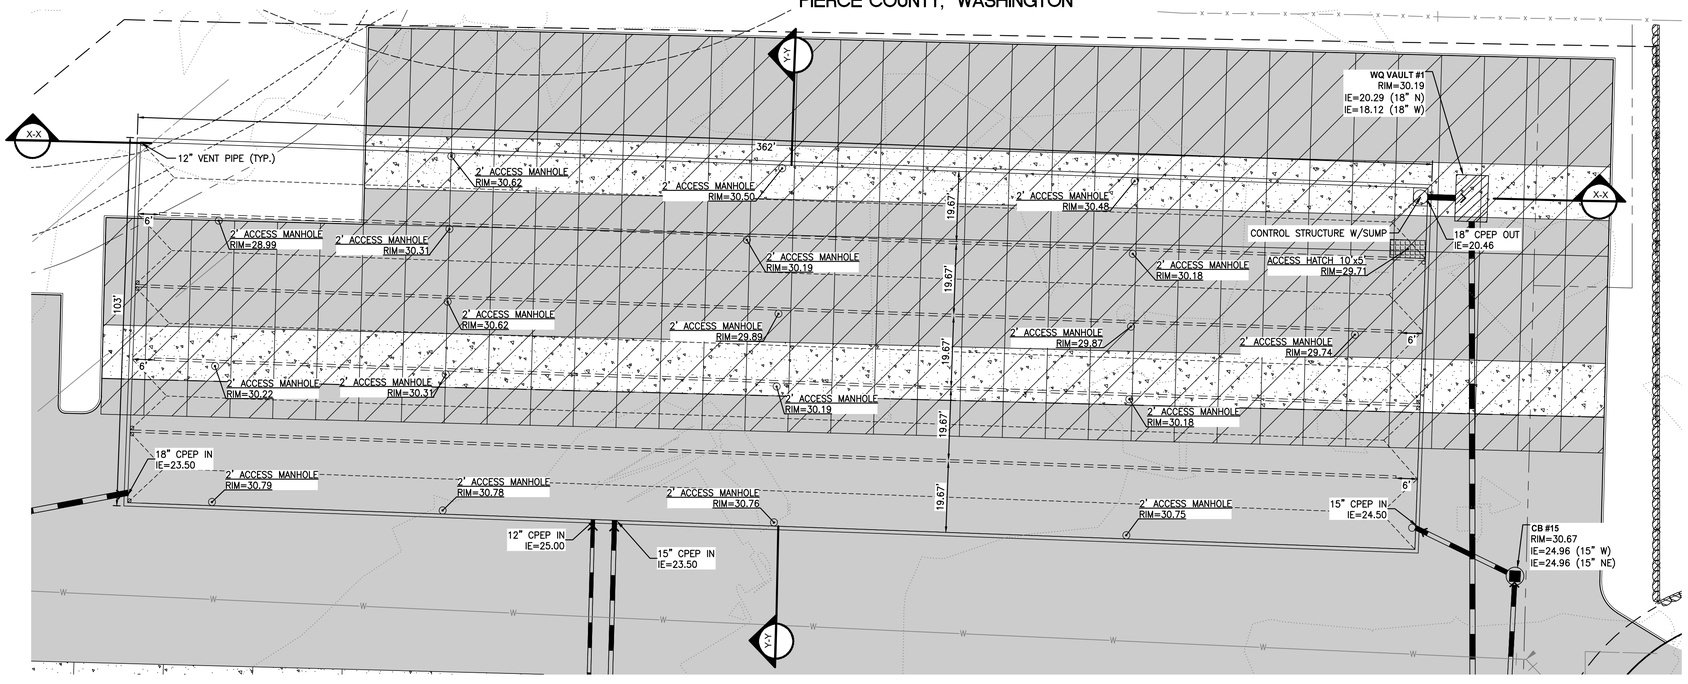


DETENTION VAULT BUILDING A

LIVE STORAGE DEPTH = 6.5 FEET
TOP OF LID = 28.50
TOP OF VAULT = 27.46
MAXIMUM WATER SURFACE = 26.96
STATIC WATER SURFACE = 20.46
BOTTOM OF VAULT = 19.47
DETENTION VOLUME REQUIRED = 230,750 CF
DETENTION VOLUME PROVIDED = 234,000 CF

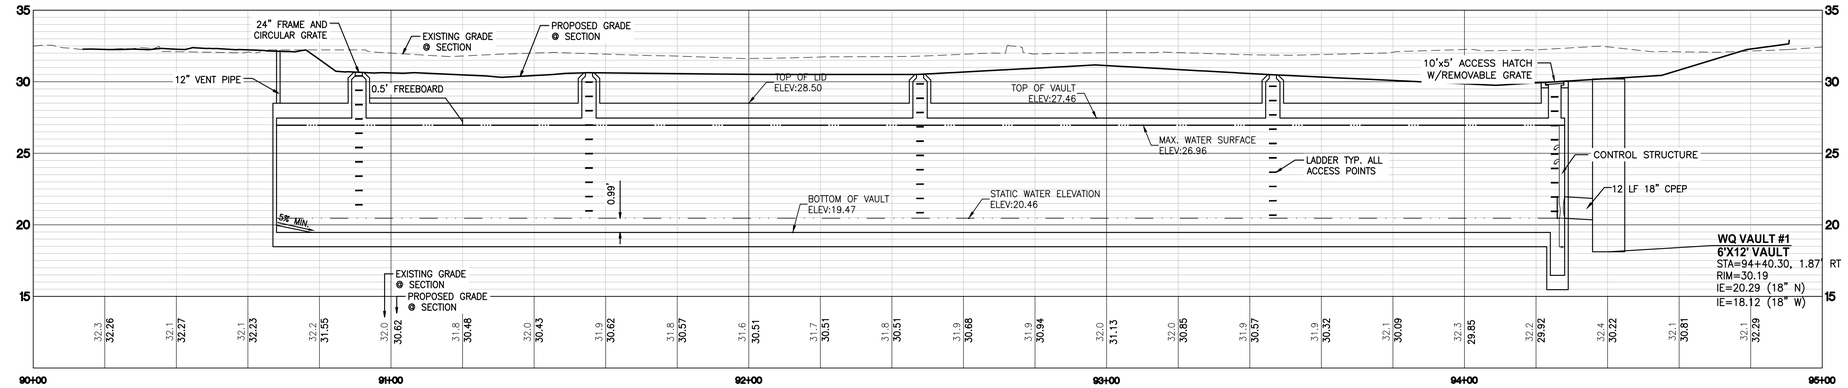

X-X DETENTION VAULT X-X SECTION

SCALE: H: 1"=20' V: 1"=5'

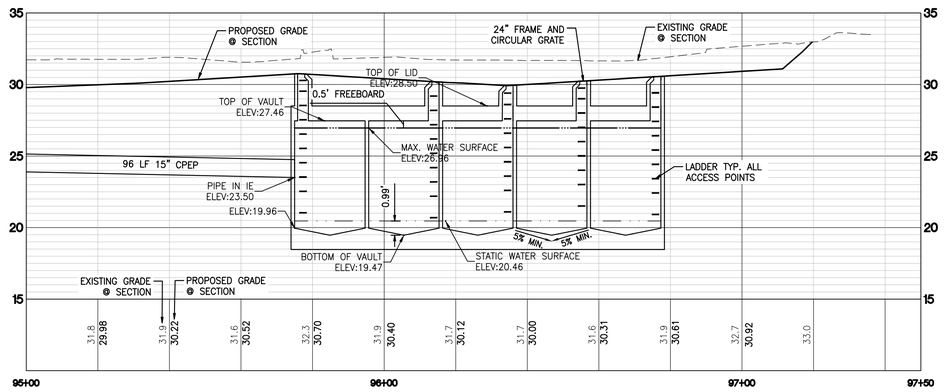

Y-Y DETENTION VAULT Y-Y SECTION

SCALE: H: 1"=20' V: 1"=5'

VAULT NOTES:

1. VENTILATION PIPES (MIN. 12" DIAMETER OR EQUIVALENT) SHALL BE PROVIDED IN ALL CORNERS OF THE VAULT TO ALLOW FOR VENTILATION PRIOR TO ENTRY OF MAINTENANCE PERSONNEL INTO VAULT. VENTILATION PIPES ENTER THROUGH THE VAULT LID. PROVIDE LOCKING LIDS FLUSH WITH FINISH GRADE USING CLEANOUT.
2. WHERE PIPES ENTER AND LEAVE THE VAULT BELOW THE DESIGNED MAX WATER SURFACE, THEY SHALL BE SEALED USING A NON-POROUS, NON-SHRINKING GROUT.
3. DETENTION VAULT HAS BEEN DESIGNED WITH THE HIGH GROUNDWATER IN MIND AND BUOYANCY WILL BE ACCOUNTED FOR IN THE STRUCTURAL DESIGN CALCULATIONS.

⚠CAUTION

Confined space Test atmosphere before entering

KEYNOTE (A)

TYPICAL AT ALL MANHOLE ACCESS MINIMUM SIGN SHALL BE 10"X7" ALUMINUM SIGN. THIS SIGN CAN BE ORDERED AT COMPLIANCESIGNS.COM, AND IS MODEL NUMBER ACE-10005

BOLT TO INSIDE OF STRUCTURE ABOVE TOP LADDER RUNG. (TYP)

CONFINED SPACE SIGNAGE TYPICAL DETAIL

NOT TO SCALE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	7/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY DETENTION VAULT PLAN - NORTH**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE
STATE OF WASHINGTON
54927
REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C14 of 48

P:\21000s\21585\engineering\SEPA SET\21585-PM-VLT.dwg 5/28/2025 2:49 PM DCASEY


PRELIMINARY DETENTION VAULT PLAN - SOUTH

OF

FREEMAN LOGISTICS


PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

0 10' 20' 40'
SCALE: 1"=20'

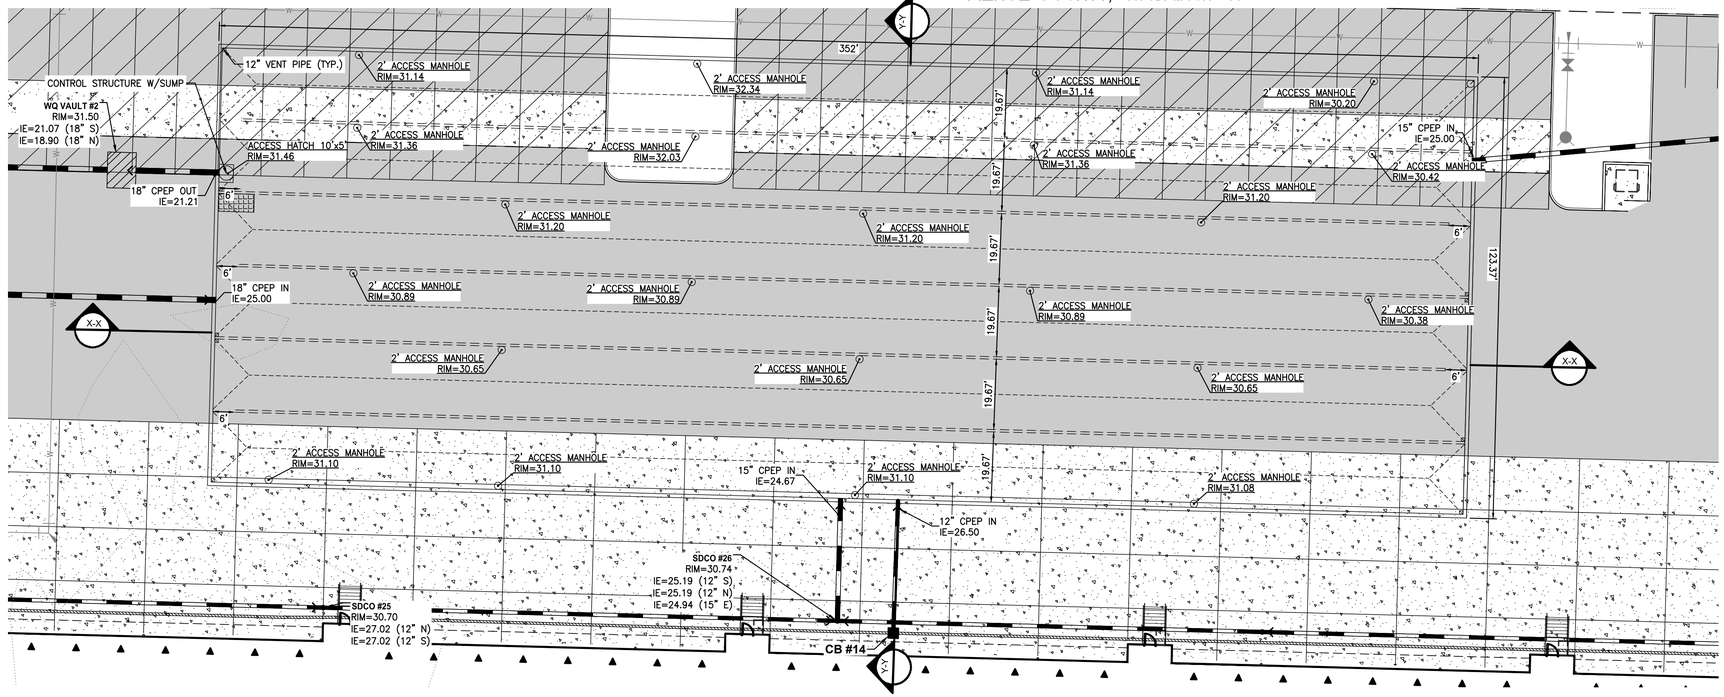


DETENTION VAULT BUILDING B

LIVE STORAGE DEPTH = 6.5 FEET
TOP OF LID = 29.25
TOP OF VAULT = 28.21
MAXIMUM WATER SURFACE = 27.71
STATIC WATER SURFACE = 21.21
BOTTOM OF VAULT = 20.22
DETENTION VOLUME REQUIRED = 261,300 CF
DETENTION VOLUME PROVIDED = 273,000 CF

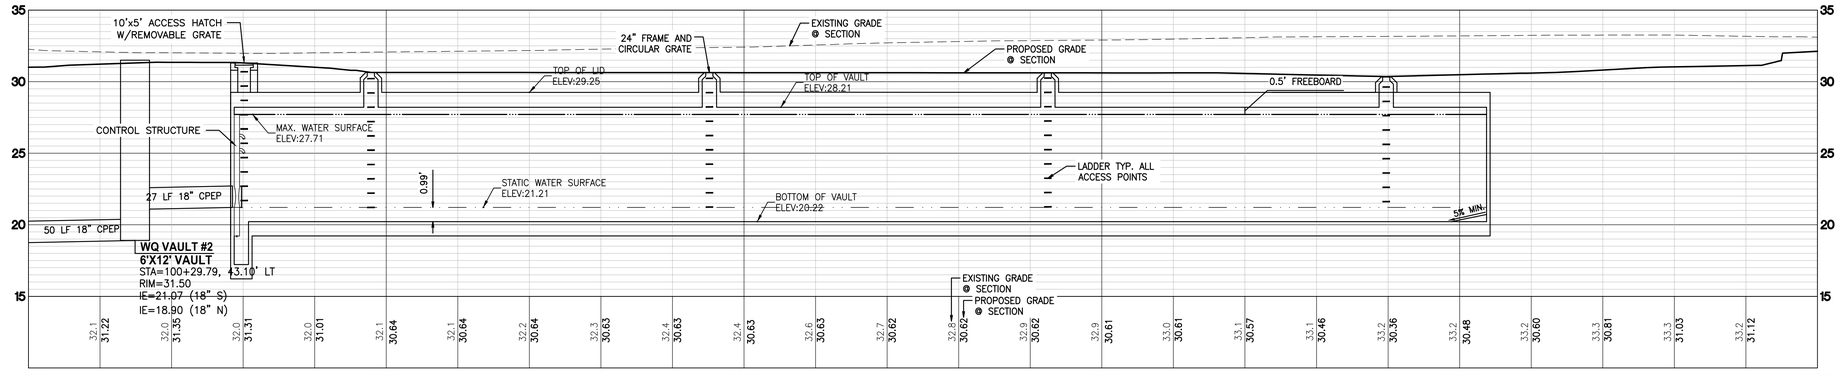

DETENTION VAULT X-X SECTION

SCALE: H: 1"=20' V: 1"=5'

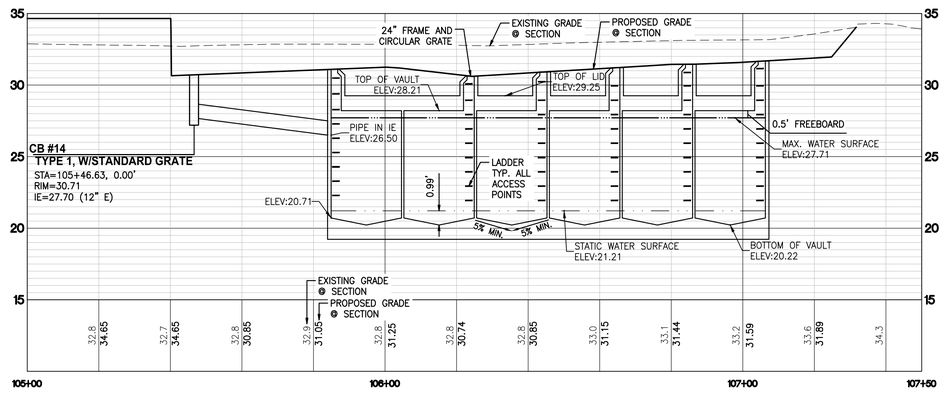

DETENTION VAULT Y-Y SECTION

SCALE: H: 1"=20' V: 1"=5'

SECTION NOTES:

1. VENTILATION PIPES (MIN. 12" DIAMETER OR EQUIVALENT) SHALL BE PROVIDED IN ALL CORNERS OF THE VAULT TO ALLOW FOR VENTILATION PRIOR TO ENTRY OF MAINTENANCE PERSONNEL INTO VAULT. VENTILATION PIPES ENTER THROUGH THE VAULT LID. PROVIDE LOCKING LIDS FLUSH WITH FINISH GRADE USING CLEANOUT.
2. WHERE PIPES ENTER AND LEAVE THE VAULT BELOW THE DESIGNED MAX WATER SURFACE, THEY SHALL BE SEALED USING A NON-POROUS, NON-SHRINKING GROUT.
3. DETENTION VAULT HAS BEEN DESIGNED WITH THE HIGH GROUNDWATER IN MIND AND BUOYANCY WILL BE ACCOUNTED FOR IN THE STRUCTURAL DESIGN CALCULATIONS.

⚠CAUTION

Confined space Test atmosphere before entering

KEYNOTE (A)

TYPICAL AT ALL MANHOLE ACCESS MINIMUM SIGN SHALL BE 10"X7" ALUMINUM SIGN. THIS SIGN CAN BE ORDERED AT COMPLIANCESIGNS.COM, AND IS MODEL NUMBER ACE-10005

BOLT TO INSIDE OF STRUCTURE ABOVE TOP LADDER RUNG. (TYP)

CONFINED SPACE SIGNAGE TYPICAL DETAIL

NOT TO SCALE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY DETENTION VAULT PLAN - SOUTH** FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCADAMS — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25


Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C15 of 48

P:\21000s\21585\engineering\SEPA SET\21585-PM-VLT.dwg 5/28/2025 2:49 PM DCASEY

PRELIMINARY WATER AND SEWER OVERALL PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

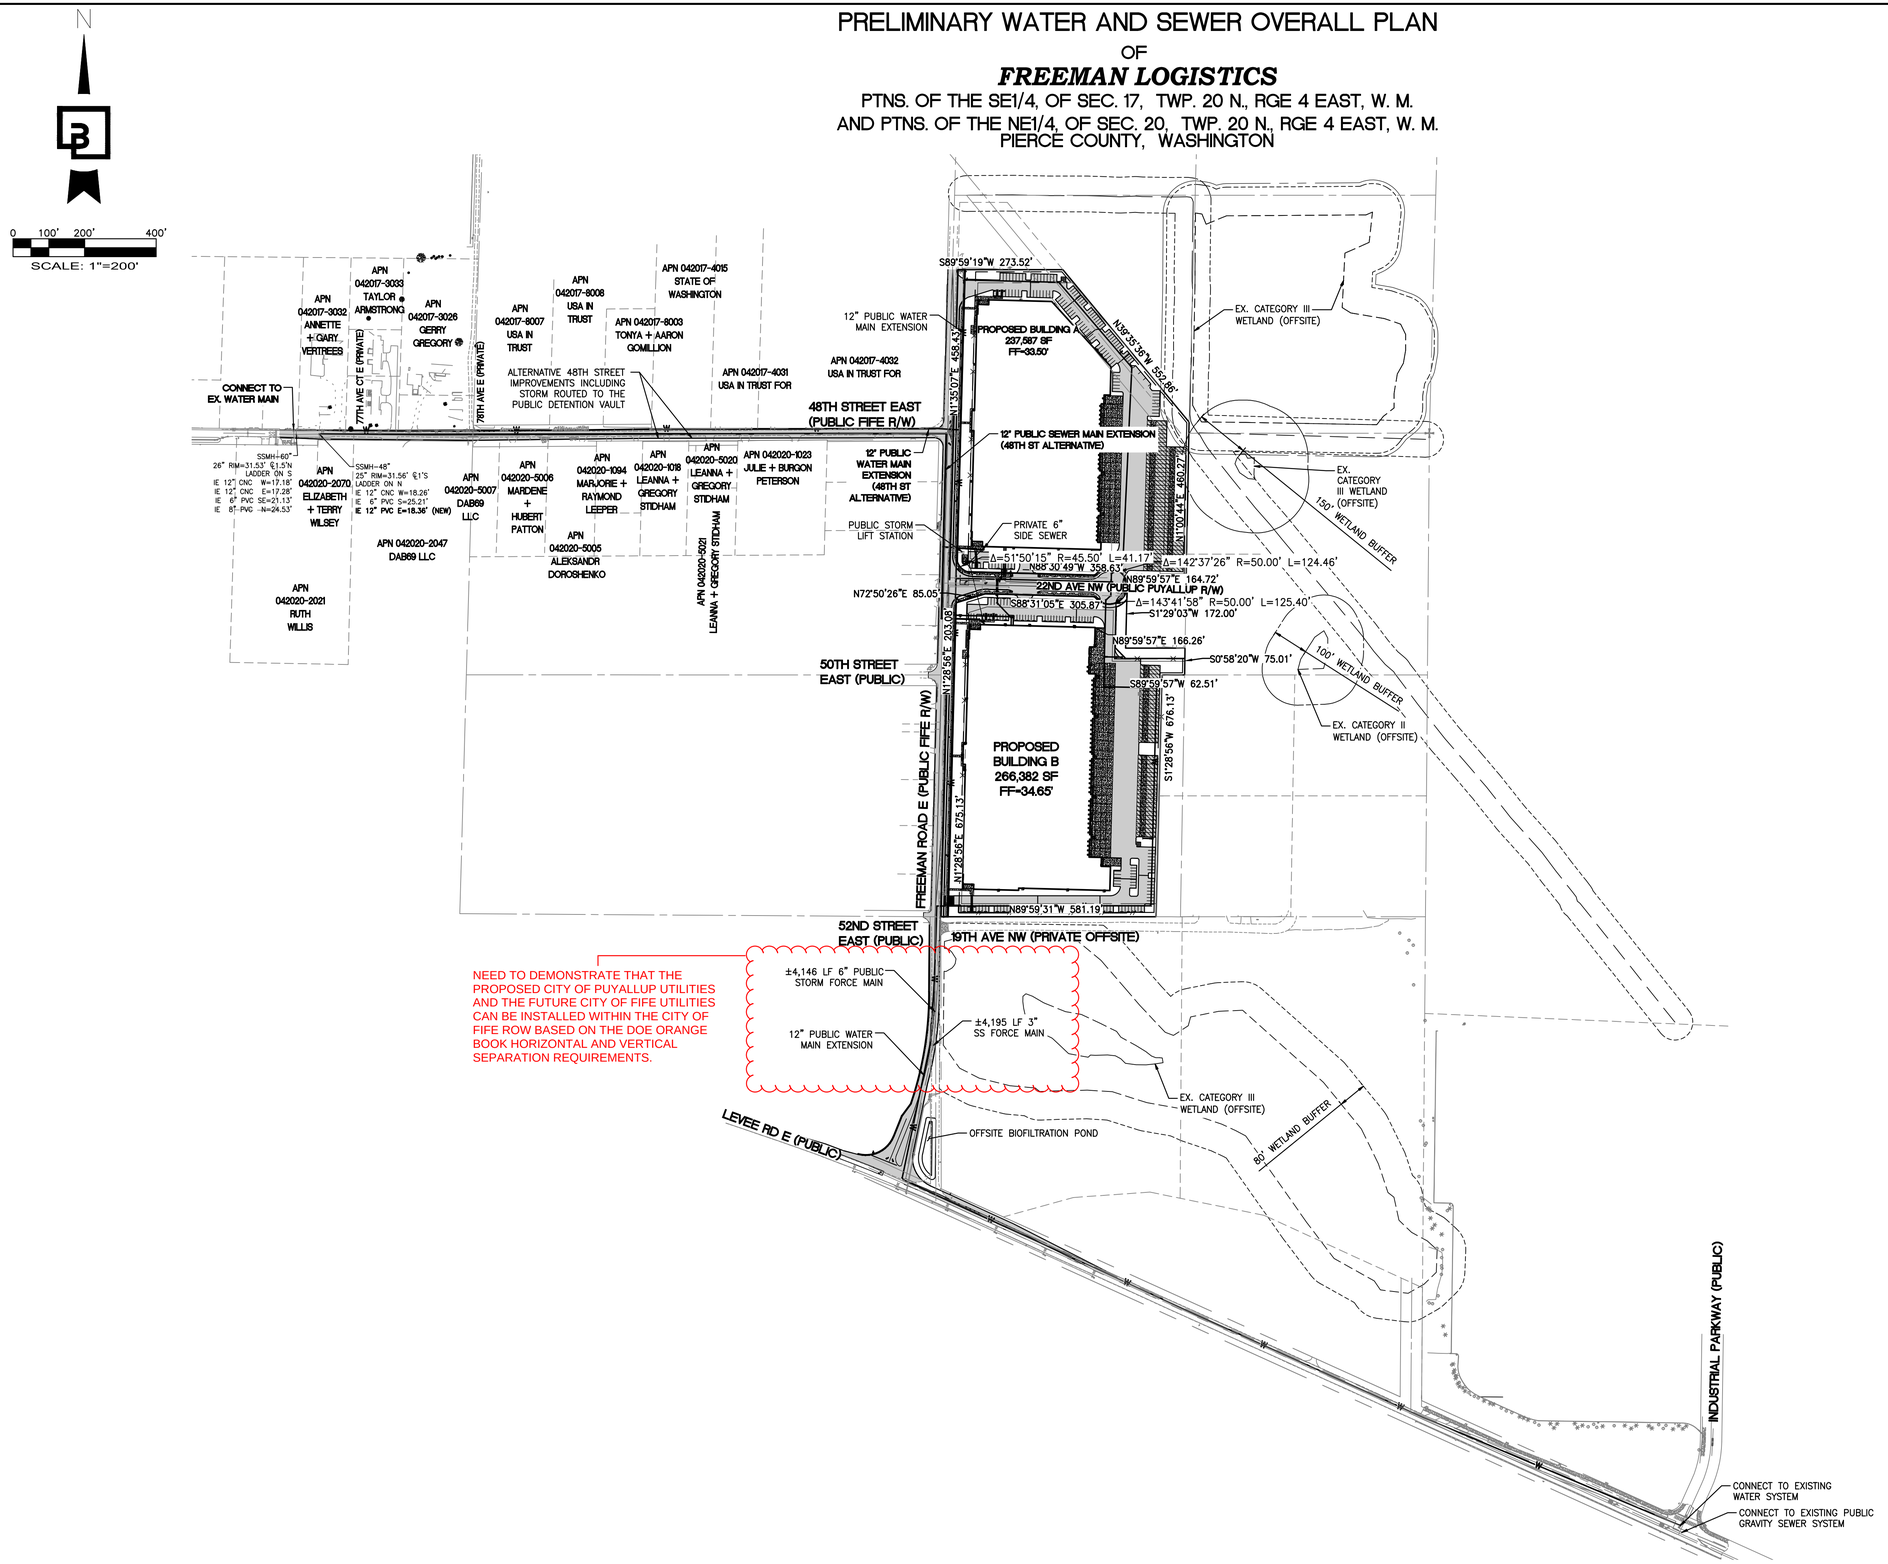

ENGINEER'S REVIEW — FIFE
- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	7/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY WATER AND SEWER OVERALL PLAN** FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=200' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Job Number 21585

Sheet C16 of 48

P:\21000s\21585\engineering\SEPA SET\21585-WS.dwg 7/16/2025 11:10 AM DCASEY

PRELIMINARY WATER AND SEWER PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 25' 50' 100'
SCALE: 1"=50'

INSTALL:
12" STUB WITH MJ PLUG FOR
FUTURE WATER CONNECTION

S89°59'19"W 273.52'

12" CL 52 D.I. W (PRIVATE)

INSTALL:
1-45° BEND (MJ)
CONCRETE BLOCKING

INSTALL:
1-12"X12" TEE (MJxFL)
3-12" BF VALVES (FLxMJ)
CONCRETE BLOCKING

INSTALL:
1-12"x6" TEE (MJxFL)
1-6" GATE VALVE (FLxMJ)
6 LF 6" D.I. W
FIRE HYDRANT ASSEMBLY
CONCRETE BLOCKING

LIGHT POLE AND JUNCTION
BOX (TYP.) PER SEPARATE
LIGHTING PLAN

INSTALL:
1-12"x6" TEE (MJxFL)
1-6" GATE VALVE (FLxMJ)
5 LF 6" D.I. W
FIRE HYDRANT ASSEMBLY
CONCRETE BLOCKING

N39°35'35"W 552.86'

INSTALL:
1-12"x6" TEE (MJxFL)
1-6" GATE VALVE (FLxMJ)
6 LF 6" D.I. W
FIRE HYDRANT ASSEMBLY
CONCRETE BLOCKING

INSTALL:
1-45° BEND (MJ)
CONCRETE BLOCKING

N1°35'07"E 458.43'

12" CL 52 D.I. W

PROPOSED BUILDING A
237,587 SF
FF=33.50'

12" CL 52 D.I. W (PRIVATE)

N1°00'44"E 460.27'

48TH ST E (PUBLIC)

(48TH ALTERNATIVE) INSTALL:
1-12"X12" TEE (MJxFL)
3-12" BF VALVES (FLxMJ)
CONCRETE BLOCKING

EVEN IF THIS ALTERNATIVE IS NOT UTILIZED. CITY OF FIFE WOULD REQUIRE A 12-NCH STUB OUT FOR A FUTURE WATER INTERTIE CONNECTION WITH THE CITY OF PUYALLUP.

SSMH #4
RIM=31.81
IE=23.34 (12" S)
IE=23.24 (12" W)

FREEMAN ROAD E
(PUBLIC FIFE R/W)

317 LF 12" SDR-35 SS @ 0.25%

INSTALL:
1-12"x6" TEE (MJxFL)
1-6" GATE VALVE (FLxMJ)
6 LF 6" D.I. W
FIRE HYDRANT ASSEMBLY
CONCRETE BLOCKING

MATCHLINE- SEE SHEET C19 FOR CONTINUATION

SSMH #10
RIM=32.69
IE=25.19 (6" N)
IE=25.02 (8" W)

SSCO #1, 6" SSCO
RIM=33.12
IE=25.29 (6" S)

113 LF 8" SDR-35 SS @ 0.40%

SSMH #3
RIM=33.73
IE=24.24 (12" S)
IE=24.57 (8" E)
IE=24.14 (12" N)

5 LF 6" SS @ 2.07%

INSTALL:
1-2" IRRIGATION METER AND
SERVICE W/BACKFLOW
PREVENTOR (DCVA)

INSTALL:
1-45° BEND (MJ)
CONCRETE BLOCKING

SEWER LIFT STATION FOR
LEVEE ALTERNATIVE

Δ=51°50'15" R=45.50' L=41.17'

INSTALL:
1-2" DOMESTIC METER
SERVICE AND RPBA

INSTALL:
1-12"X12" TEE (MJxFL)
3-12" BF VALVES (FLxMJ)
CONCRETE BLOCKING

FDC

INSTALL:
1-12"x6" TEE (MJxFL)
1-6" GATE VALVE (FLxMJ)
24 LF 6" D.I. W
FIRE HYDRANT ASSEMBLY
CONCRETE BLOCKING

INSTALL:
1-45° BEND (MJ)
CONCRETE BLOCKING

N88°30'49"W 358.63'

Δ=142°37'26" R=50.00' L=124.46'

200 LF 12" SDR-35 SS @ 0.25%

INSTALL:
1-2" GATE VALVE
1-2" DOMESTIC METER
SERVICE AND RPBA

N72°50'26"E 85.05'

INSTALL:
1-12"x10" TEE (MJxFL)
1-10" GATE VALVE (FLxMJ)
PROPOSED 10" DCVA
FIRE LINE W/PIV
CONCRETE BLOCKING

22ND AVE NW (PUBLIC PUYALLUP R/W)

INSTALL:
1-12"x6" TEE (MJxFL)
1-6" GATE VALVE (FLxMJ)
23 LF 6" D.I. W
FIRE HYDRANT ASSEMBLY
CONCRETE BLOCKING

N89°59'57"E 164.72'

INSTALL:
1-12"X12" TEE (MJxFL)
2-12" BF VALVES (FLxMJ)
CONCRETE BLOCKING

S88°31'05"E 305.87'

Δ=143°41'58" R=50.00' L=125.40'

INSTALL:
1-2" GATE VALVE
1-2" IRRIGATION METER AND SERVICE
W/BACKFLOW PREVENTOR (DCVA)

SSMH #1
RIM=34.46
IE=25.60 (6" SE)
IE=25.10 (12" W)

INSTALL:
1-45° BEND (MJ)
CONCRETE BLOCKING

S1°29'03"W 172.00'

106 LF 12" SDR-35 SS @ 0.25%

SSMH #2
RIM=34.30
IE=24.84 (12" E)
IE=24.74 (12" N)

FDC

17 LF 6" SS @ 2.00%

INSTALL:
1-12"x6" TEE (MJxFL)
1-6" GATE VALVE (FLxMJ)
5 LF 6" D.I. W
FIRE HYDRANT ASSEMBLY
CONCRETE BLOCKING

MATCHLINE- SEE SHEET C18 FOR CONTINUATION

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY WATER AND SEWER PLAN**

FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MARSH
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=50' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen
Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C17 of 48

P:\21000s\21585\engineering\SEPA SET\21585-WS.dwg 7/16/2025 11:10 AM DCASEY

ENGINEER'S REVIEW
FIFE WASHINGTON
- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

PRELIMINARY WATER AND SEWER PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 25' 50' 100'
SCALE: 1"=50'

MATCHLINE- SEE SHEET C17 FOR CONTINUATION

50TH STREET EAST (PUBLIC)

FREEMAN ROAD E (PUBLIC FIFE R/W)

52ND STREET EAST (PUBLIC)

19TH AVE NW (PRIVATE)

SSCO #2, 6" SSCO
RIM=34.36
IE=25.95 (6" NW)

N1°28'56"E 203.08'

12" CL 52 DI W

INSTALL:
1-12"x6" TEE (MJxFL)
1-6" GATE VALVE (FLxMJ)
5 LF 6" D.I. W
FIRE HYDRANT ASSEMBLY
CONCRETE BLOCKING

LIGHT POLE AND JUNCTION BOX (TYP.) PER SEPARATE LIGHTING PLAN

N1°28'56"E 675.13'

INSTALL:
1-12"x6" TEE (MJxFL)
1-6" GATE VALVE (FLxMJ)
5 LF 6" D.I. W
FIRE HYDRANT ASSEMBLY
CONCRETE BLOCKING

(LEVEE ALTERNATIVE) INSTALL:
1-12"X12" TEE (MJxFL)
2-12" BF VALVE (FLxMJ)
CONCRETE BLOCKING
CONTINUE EXTENSION SOUTH

INSTALL:
1-90° BEND (MJ)
CONCRETE BLOCKING

FIRE ACCESS ONLY

PROPOSED
BUILDING B
266,382 SF
FF=34.65'

INSTALL:
1-12"x8" TEE (MJxFL)
1-8" GATE VALVE (FLxMJ)
33 LF 8" D.I. W

12" CL 52 D.I. W (PRIVATE)

INSTALL:
1-12"x6" TEE (MJxFL)
1-6" GATE VALVE (FLxMJ)
17 LF 8" D.I. W
1-8" PLUG (MJ)

66.26'

S0°58'20"W 75.01'

S89°59'57"W 62.51'

INSTALL:
1-90° BEND (MJ)
CONCRETE BLOCKING

INSTALL:
1-90° BEND (MJ)
CONCRETE BLOCKING

S1°28'56"W 676.13'

12" CL 52 DI W (PRIVATE)

INSTALL:
1-12"x6" TEE (MJxFL)
1-6" GATE VALVE (FLxMJ)
26 LF 6" D.I. W
FIRE HYDRANT ASSEMBLY
CONCRETE BLOCKING

INSTALL:
1-90° BEND (MJ)
CONCRETE BLOCKING

N89°59'31"W 581.19'

ENGINEER'S REVIEW
- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

FIFE WASHINGTON

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY WATER AND SEWER PLAN**

FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCAFEE
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=50' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Job Number 21585

Sheet C18 of 48

P:\21000s\21585\engineering\SEPA SET\21585-WS.dwg 7/16/2025 11:10 AM DCASEY


PRELIMINARY WATER AND SEWER PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

SHEETS C19 AND C28-C31 PROVIDED FOR REVIEW BY CITY OF FIFE FOR ALTERNATE SEWER CONNECTION AND WATER SYSTEM INTERTIE TO CITY OF PUYALLUP. CONCEPTUAL ROAD WIDENING AND STORMWATER SYSTEM ARE ALSO PROVIDED. THESE ALTERNATE IMPROVEMENTS ARE AT OWNER'S SOLE DISCRETION.

N

0 20' 40' 80'
SCALE: 1"=40'

Water & sewer spacing is 10' minimum; suggest shifting water line along 48th St further south, while still maintaining the 10' separation from the sewer line, in order to stay within the public ROW

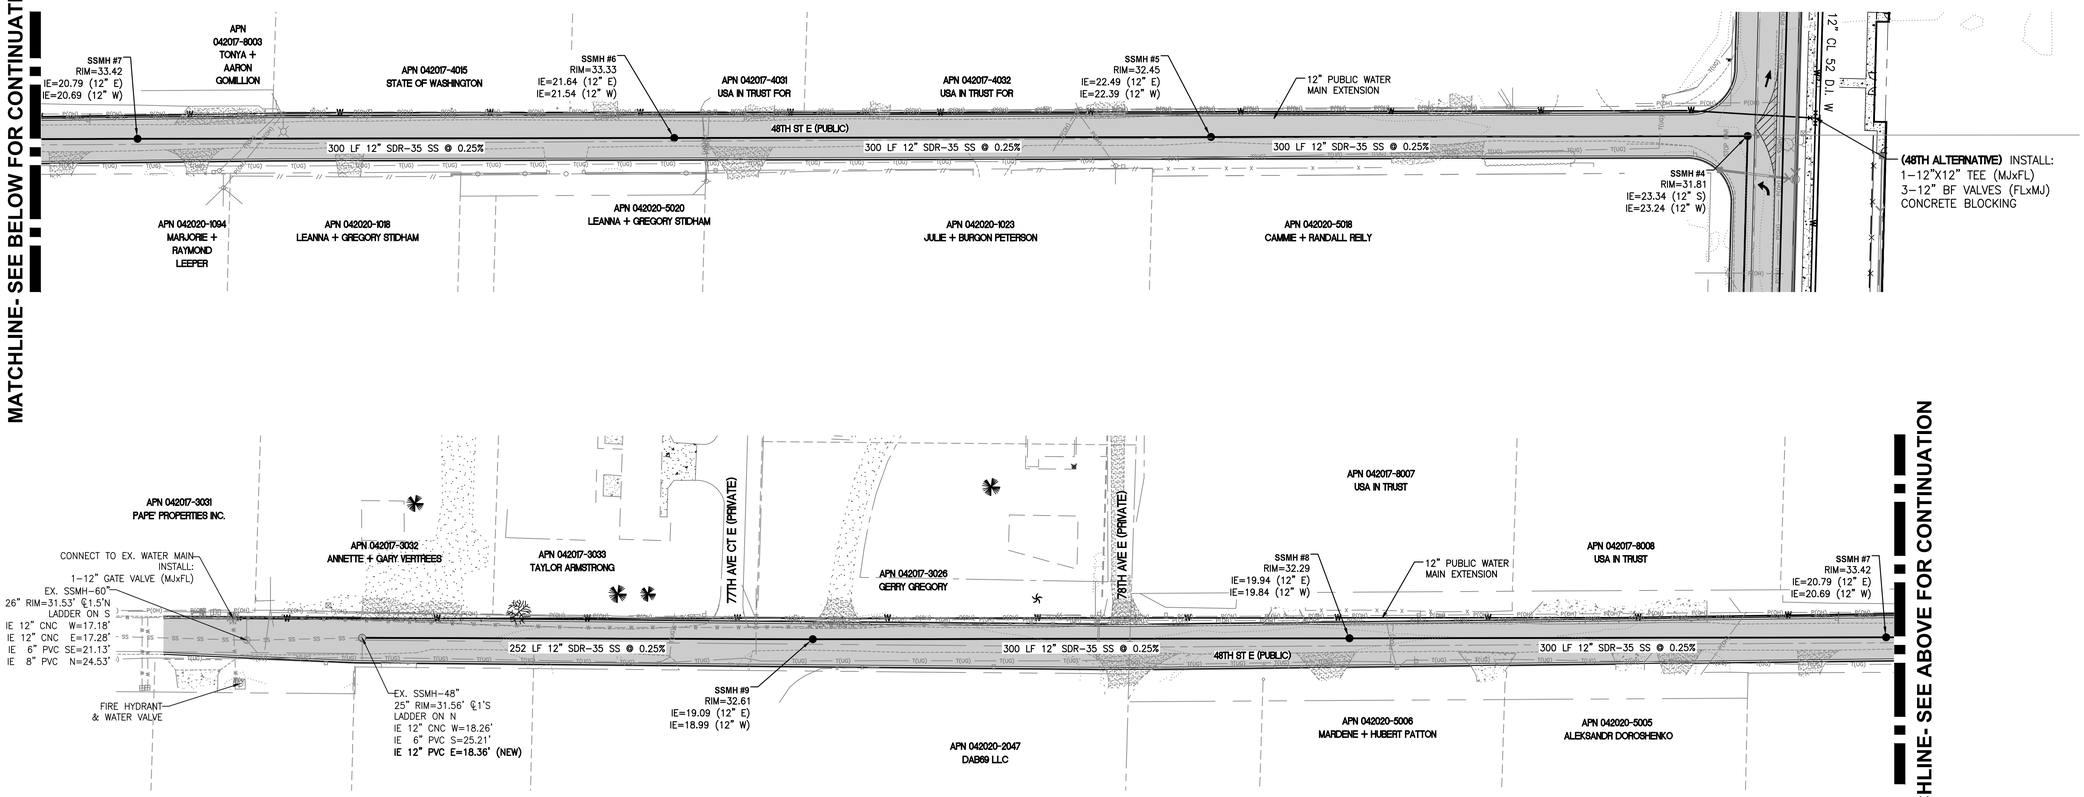

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY WATER AND SEWER PLAN**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE
STATE OF WASHINGTON
54927
REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=40' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C19 of 48

P:\21000s\21585\engineering\SEPA SET\21585-WS.dwg 7/16/2025 11:10 AM DCASEY

ENGINEER'S REVIEW FIFE
- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____


NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

PRELIMINARY ROAD IMPROVEMENT FREEMAN AND LEVEE INTERSECTION

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

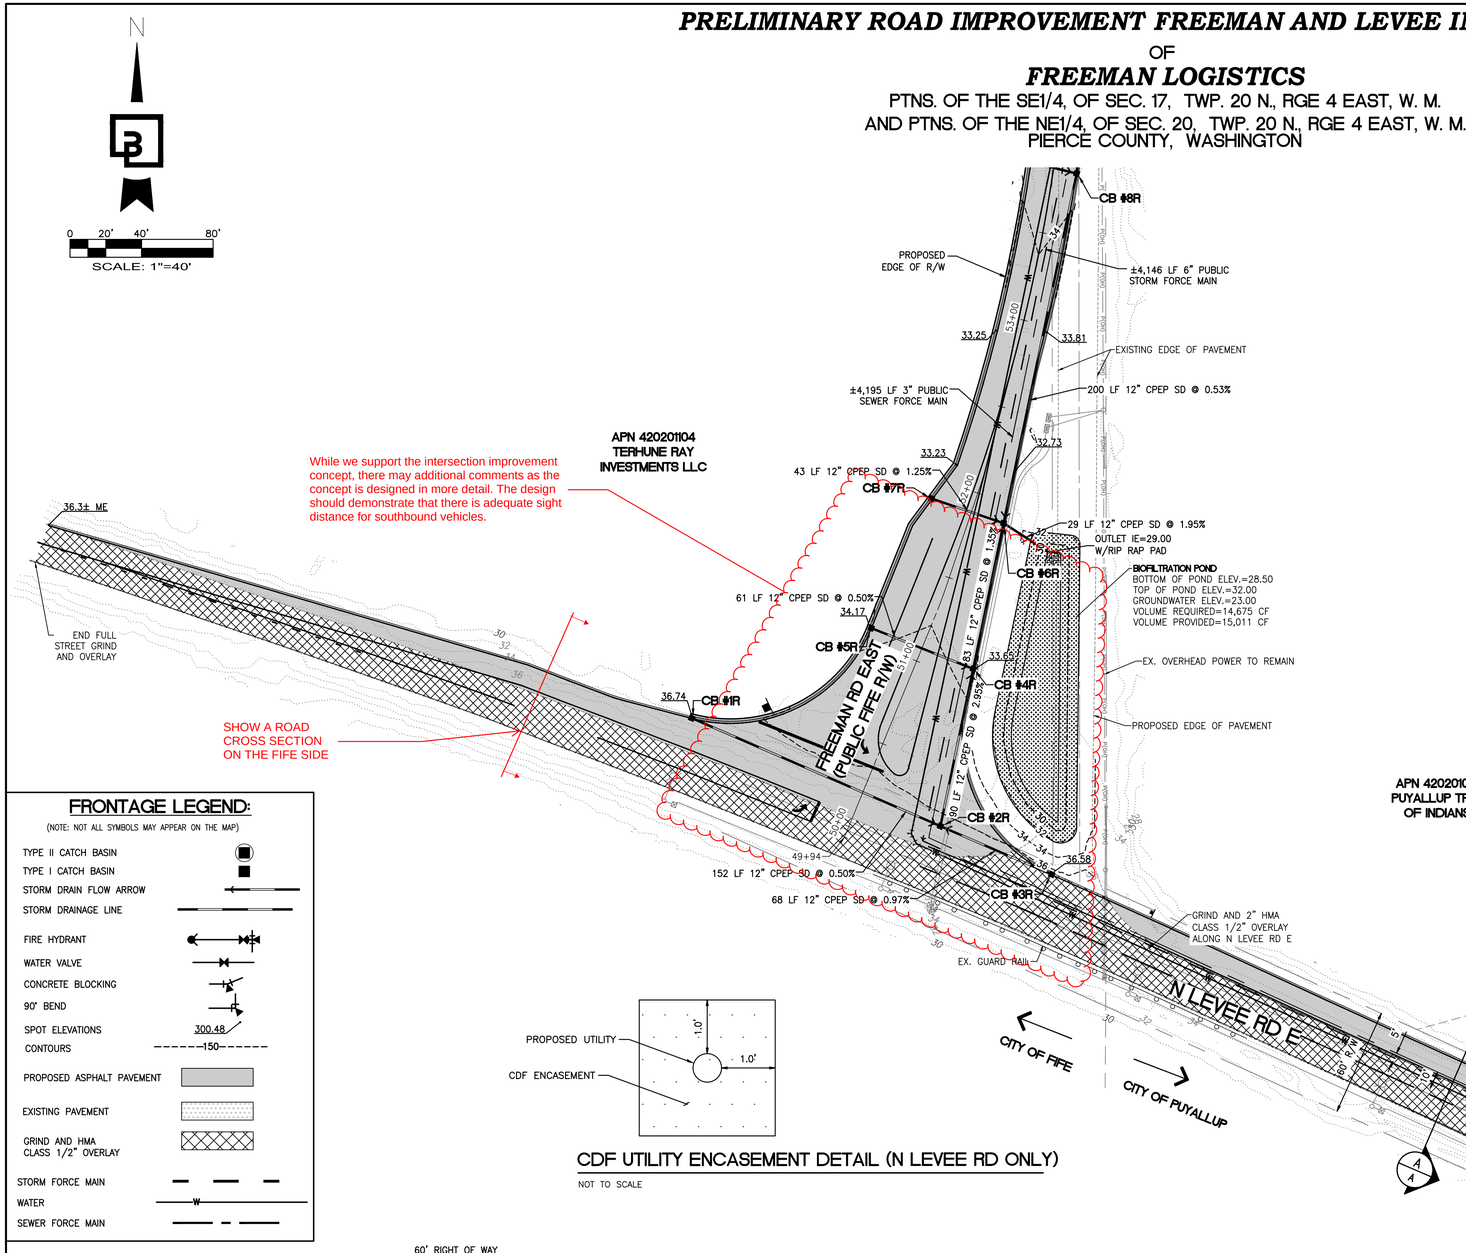


FRONTAGE LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS 150
- PROPOSED ASPHALT PAVEMENT
- EXISTING PAVEMENT
- GRIND AND HMA CLASS 1/2" OVERLAY
- STORM FORCE MAIN
- WATER W
- SEWER FORCE MAIN


CDF UTILITY ENCASEMENT DETAIL (N LEVEE RD ONLY)

NOT TO SCALE

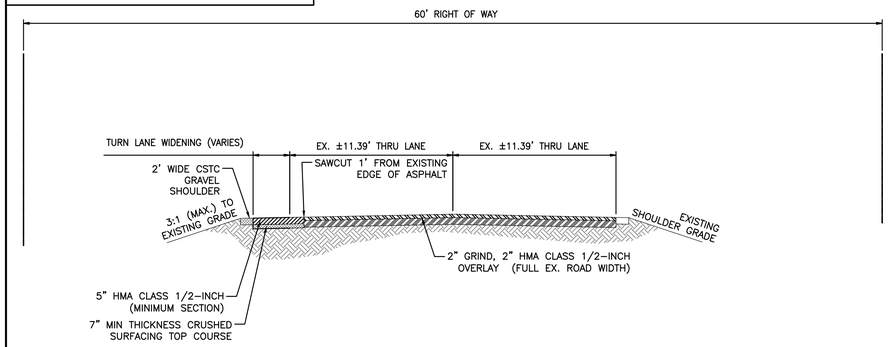

NORTH LEVEE ROAD EAST SECTION A

NOT TO SCALE

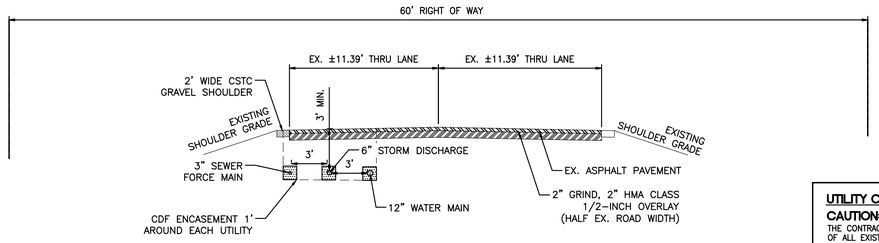

NORTH LEVEE ROAD EAST SECTION E

NOT TO SCALE

CITY OF FIFE GENERAL NOTES

1. ALL SPECIFICATIONS, MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE CITY OF FIFE MUNICIPAL CODE, THE LATEST EDITION OF THE WSDOT/APWA STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION, AND THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES.
2. PLANS AND DETAILS SHALL BE IN ACCORDANCE WITH THE CITY OF FIFE MUNICIPAL CODE AND THE LATEST EDITION OF THE WSDOT/APWA STANDARD PLANS.
3. A COPY OF THE APPROVED PLANS SHALL BE ON SITE DURING CONSTRUCTION.
4. CONSTRUCTION OF PROPOSED IMPROVEMENTS SHALL BE IN ACCORDANCE WITH THE APPROVED PLANS. ANY CHANGES FROM THE "APPROVED" PLANS WILL REQUIRE APPROVAL FROM THE DEVELOPER, DEVELOPERS ENGINEER AND THE CITY OF FIFE.
5. A PRE-CONSTRUCTION MEETING AND ANY REQUIRED PERMITS SHALL BE REQUIRED PRIOR TO ANY WORK ACTIVITY. THE PRE-CONSTRUCTION MEETING SHALL BE HELD AT FIFE CITY HALL.
6. DURING CONSTRUCTION, THE CONTRACTOR SHALL BE REQUIRED TO CONTROL ON SITE STORM WATER RUNOFF BY USING APPROVED TEMPORARY OR PERMANENT DRAINAGE EROSION/SILTATION CONTROL PROCEDURES. THE CITY OF FIFE HAS ADOPTED THE STORMWATER MANAGEMENT MANUAL FOR THE PUGET SOUND BASIN (THE TECHNICAL MANUAL) DEVELOPED BY THE DEPARTMENT OF ECOLOGY.
7. PRIOR TO STARTING CONSTRUCTION, THE CONTRACTOR SHALL CALL ONE-CALL (1-800-425-5555) FOR UTILITY LOCATIONS (WATER, SANITARY SEWER, STORM SEWER, GAS, POWER, TELEPHONE AND CABLE TV).
8. LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE TRUE ELEVATIONS AND LOCATIONS OF EXISTING UTILITIES. ANY UTILITY RELOCATIONS SHALL BE AT THE EXPENSE OF THE APPLICANT AND MUST BE IN ACCORDANCE WITH THE CITY OF FIFE'S STANDARDS.
9. NO SAW CUTTING IN THE RIGHT-OF-WAY WILL BE ALLOWED WITHOUT PRIOR APPROVAL FROM THE CITY OF FIFE. ONCE APPROVED, EXISTING PAVEMENT SURFACES SHALL BE SAW CUT FULL DEPTH WITH STRAIGHT, UNIFORM EDGES TWELVE INCHES (12") OUT FROM THE EDGE OF EXCAVATION. IF SLOUGHING OCCURS DURING EXCAVATION, THE EXISTING PAVEMENT SHALL BE SAW CUT TO ACHIEVE THE REQUIRED 12 INCHES (12") FROM THE EDGE OF EXCAVATION.
10. LANE CLOSURES SHALL BE RESTRICTED TO 9:00 A.M. TO 3:00 P.M. MONDAY THROUGH FRIDAY. ONE LANE (MINIMUM) SHALL BE RESERVED FOR TRAFFIC (BOTH DIRECTIONS) AT ALL TIMES. WORK IN THE RIGHT OF WAY REQUIRES A RIGHT-OF-WAY PERMIT. NIGHT, WEEKEND, OR WORK HOURS OTHER THAN HOURS MENTIONED ABOVE WILL REQUIRE THE CITY OF FIFE ENGINEER'S APPROVAL. A THREE DAY ADVANCE NOTICE IS REQUIRED. ACCESS TO EXISTING DRIVEWAYS SHALL BE MAINTAINED AT ALL TIMES.
11. IF WORK IS REQUIRED IN THE RIGHT-OF-WAY, THE CONTRACTOR SHALL PROVIDE PROOF OF LIABILITY INSURANCE IN AN AMOUNT NO LESS THAT ONE MILLION DOLLARS PER OCCURRENCE AND A $10,000 (OR 125% OF CONSTRUCTION COSTS) RESTORATION/DEFECT BOND ON CITY OF FIFE FORMS. THE CONTRACTOR SHALL ALSO PROVIDE A TRAFFIC CONTROL PLAN FOR REVIEW AND APPROVAL A MINIMUM OF FIVE(5) DAYS PRIOR TO STARTING THE WORK. ALL TRAFFIC CONTROL DEVICES SHALL BE IN ACCORDANCE WITH THE "MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES".
12. THE CONTRACTOR SHALL CONTACT PIERCE COUNTY TRANSIT AND THE FIFE SCHOOL DISTRICT FOR COORDINATING BUS STOP OPERATIONS DURING CONSTRUCTION, IF NECESSARY.
13. NO CONSTRUCTION, EXCAVATION, HAULING OR REMOVAL OF FILL SHALL BE PERMITTED BETWEEN THE HOURS OF 10:00 P.M. AND 7:00 A.M. WEEKDAYS OR 10:00 P.M. AND 9:00 A.M. ON WEEKENDS.
14. CUT SLOPES SHALL NOT BE STEEPER THAN 2 HORIZONTAL TO 1 VERTICAL AND FILL SLOPES SHALL NOT BE STEEPER THAN 1-1/2 HORIZONTAL TO 1 VERTICAL, OR AS RECOMMENDED BY A SOILS ENGINEER. THE CATCH POINTS OF THE TOP OF CUT SLOPES AND BOTTOM OF FILL SLOPES SHALL BE SET BACK FROM THE SITE BOUNDARY LINES IN ACCORDANCE WITH THE FOLLOWING TABLE, UNLESS A RETAINING WALL IS DESIGNED BY THE ENGINEER AND CONSTRUCTED FOR THIS PROJECT:

CUT/FILL DEPTH	SET BACK DISTANCE
UNDER 5 FEET	2 FEET
5 FEET AND OVER	HEIGHT/2

15. ISSUANCE OF A PERMIT BY THE CITY OF FIFE DOES NOT IMPLY OR SIGNIFY THAT THE PROPOSED WORK COMPLIES WITH THE REQUIREMENTS OF OR IS ALLOWED BY OTHER COUNTY, STATE, OR FEDERAL LAWS, ORDINANCES, OR REGULATIONS. APPLICANT WILL ACCEPT SOLE RESPONSIBILITY AND LIABILITY FOR COMPLIANCE WITH ALL LOCAL, STATE, AND FEDERAL REQUIREMENTS.
16. "AS-BUILT" DRAWINGS CERTIFIED BY A LICENSED LAND SURVEYOR OR PROFESSIONAL ENGINEER ARE REQUIRED FOR RIGHT-OF-WAY IMPROVEMENTS AND ANY SITE CIVIL WORK. THESE DRAWINGS SHALL BE SUBMITTED ON 24" X 36" MYLAR, ON CD IN ELECTRONIC PDF FORMAT AS APPROVED BY THE CITY AND RECEIVE APPROVAL FROM THE CITY BEFORE A CERTIFICATE OF OCCUPANCY IS ISSUED.
17. ALL STORM PIPE SHALL BE INSTALLED WITH RUBBER GASKETED JOINTS. PIPES SHALL NOT ALLOW INTRUSION OF GROUNDWATER INTO STORM SYSTEM. PIPES SHALL BE INSTALLED WATER TIGHT AND AIR TESTED.
18. ALL EXCAVATIONS IN ROADWAYS SHALL BE BACKFILLED FULL-DEPTH WITH CRUSHED ROCK BASE COURSE COMPACTED TO 95% MDD.
19. CURB AND GUTTER SECTIONS IN THE RIGHT-OF-WAY SHALL BE CONSTRUCTED USING FORMS. EXTRUDED APPLICATIONS SHALL NOT BE ACCEPTED, CONCRETE TO BE MINIMUM 4,000 PSI STRENGTH.
20. ALL TYPE II CATCH BASINS NOT DIRECTLY PICKING UP STORM DRAINAGE SHALL HAVE ROUND SOLID LOCKING LIDS. LIDS WILL NOT BE CONSTRUCTED IN THE CURB AND GUTTER LINE OR WHEEL PATH.
21. ALL DRIVEWAYS TO HAVE 6" THICK CONCRETE PAVING FOR ADDITIONAL STRENGTH. MIN. 4,000 PSI STRENGTH.
22. HDPE STORM PIPE TO MEET ASTM F810-93.
23. ALL STRUCTURES LARGER THAN A TYPE 1 CATCH BASIN SHALL REQUIRE A MINIMUM OF 12" THICKNESS OF 4" - 8" QUARRY SPALLS FOR BASE AND MINIMUM OF 12" OUTSIDE OF STRUCTURE, OVER 260# FABRIC PER ASTM D-4632

ENGINEER'S REVIEW

FIFE WASHINGTON

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

CALL BEFORE YOU DIG: 1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:

THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY ROAD IMPROVEMENT FREEMAN AND LEVEE INTERSECTION FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCKEE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=40' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C20 of 48

P:\21000s\21585\engineering\SEPA SET\21585-R.dwg 7/15/2025 8:49 AM DCASEY

PRELIMINARY ROAD IMPROVEMENTS STA 50+00 TO 55+00

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

SCALE: 1"=20'

SHOULD SHOW THIS ROAD CROSS SECTION OF THE INTERSECTION.

Relocate CB out of traveled way and grade road accordingly to drain

The area proposed for road construction outside of the existing ROWs will require additional geotechnical analysis to ensure adequacy for road building and to determine appropriate pavement section

Provide a pond cross-section and bioretention details

Remove existing pavement down to base

Provide driveway access to the pond in this vicinity; include gate and No Trespassing sign; add gravel drive to connect to existing pavement

Remove existing pavement down to base

Remove existing pavement down to base

MATCHLINE STA 55+00 SEE SHEET C22 FOR CONTINUATION

APN 420201104
TERHUNE RAY
INVESTMENTS LLC

APN 420201008
PUYALLUP TRIBE
OF INDIANS

CITY OF FIFE

CITY OF PUYALLUP

N LEVEE RD E

FREEMAN RD EAST
(PUBLIC FIFE R/W)

PROPOSED EDGE OF R/W

152 LF 12" CPEP SD @ 0.50%

LIGHT POLE AND JUNCTION BOX (TYP.) PER SEPARATE LIGHTING PLAN

±4,146 LF 6" PUBLIC STORM FORCE MAIN

68 LF 12" CPEP SD @ 0.97%

90 LF 12" CPEP SD @ 2.95%

83 LF 12" CPEP SD @ 1.35%

61 LF 12" CPEP SD @ 0.50%

43 LF 12" CPEP SD @ 1.25%

29 LF 12" CPEP SD @ 1.95%

200 LF 12" CPEP SD @ 0.53%

26 LF 12" CPEP SD @ 1.62%

151 LF 12" CPEP SD @ 0.53%

±4,195 LF 3" PUBLIC SEWER FORCE MAIN


CB #1R
CB #2R
CB #3R
CB #4R
CB #5R
CB #6R
CB #7R
CB #8R
CB #9R

BIORETENTION/INFILTRATION POND
BOTTOM OF POND ELEV.=28.50
TOP OF POND ELEV.=32.00
GROUNDWATER ELEV.=23.00
VOLUME REQUIRED=14,675 CF
VOLUME PROVIDED=15,011 CF
BOTTOM AREA=2,714 SF

OUTLET IE=29.00
W/RIP RAP PAD


RIP RAP PAD DETAIL

NOT TO SCALE

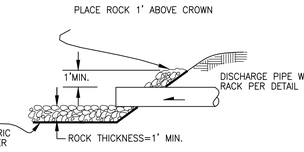


PAD WIDTH = PIPE DIAMETER + 6'
PAD LENGTH = 8' OR 4 x PIPE DIAMETER

RIP RAP SHALL BE QUARRY SPALLS WITH FOLLOWING GRADATION:
PASSING 8" SQUARE SIEVE = 100%
PASSING 3" SQUARE SIEVE = 40%–60% MAX.
PASSING ¾" SQUARE SIEVE = 0%–10% MAX.

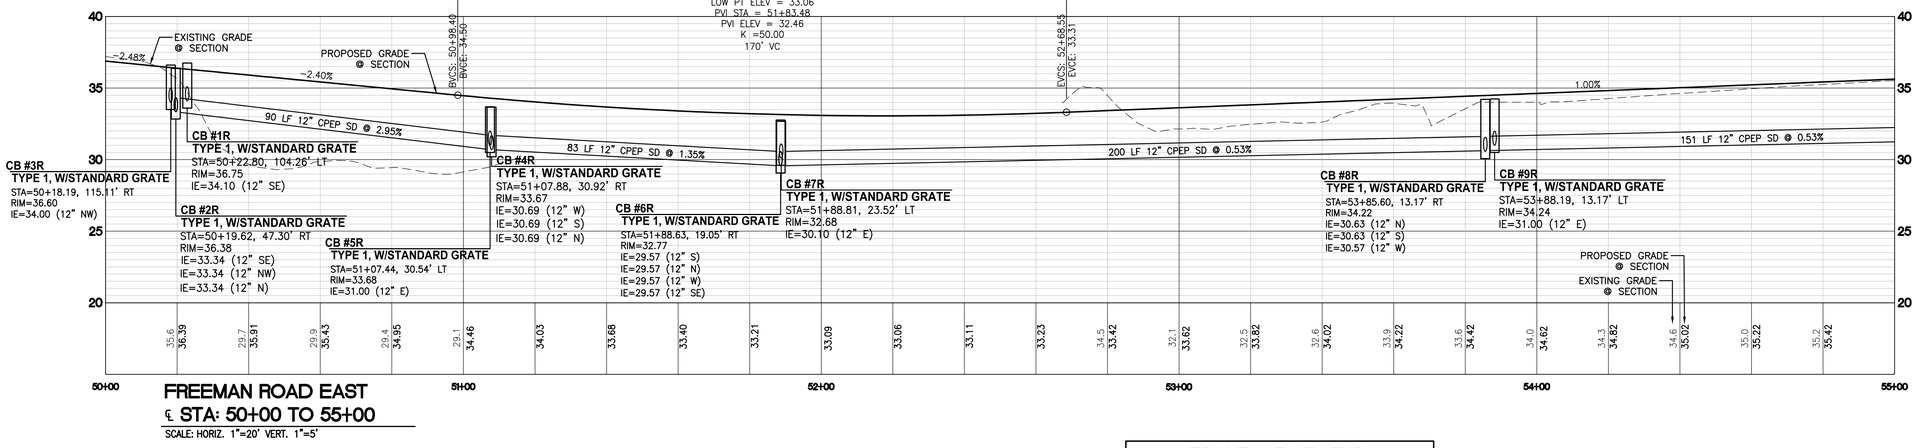

FREEMAN ROAD EAST
℄ STA: 50+00 TO 55+00


SCALE: HORIZ. 1"=20' VERT. 1"=5'

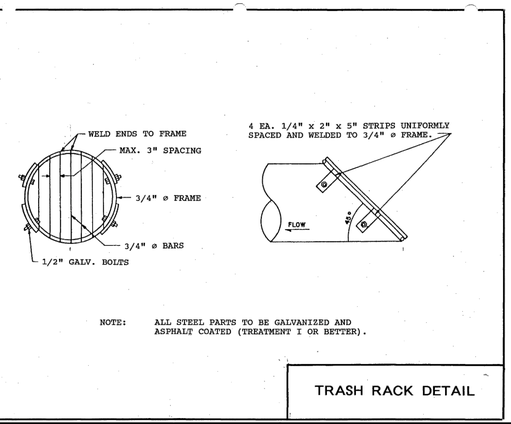

NOTE: ALL STEEL PARTS TO BE GALVANIZED AND ASPHALT COATED (TREATMENT I OR BETTER).

TRASH RACK DETAIL

Show the side slopes and edge treatments behind the curbs on both sides; provide cross-sections a minimum of 25' from N Levee Rd to 52nd St

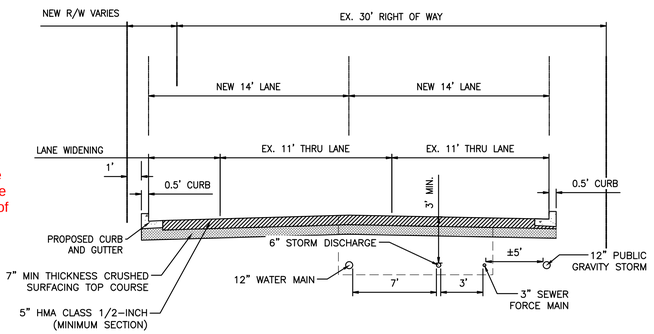

FREEMAN ROAD EAST SECTION B

NOT TO SCALE

FRONTAGE LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS 150
- PROPOSED ASPHALT PAVEMENT
- EXISTING PAVEMENT
- GRIND AND HMA CLASS 1/2" OVERLAY
- STORM FORCE MAIN
- WATER
- SEWER FORCE MAIN

ENGINEER'S REVIEW — FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY _____ DATE _____

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	7/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY ROAD IMPROVEMENTS STA 50+00 TO 55+00 FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

JASON S. MCRAE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER — 7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Job Number 21585

Sheet C21 of 48

P:\21000s\21585\engineering\SEPA SET\21585-R.dwg 7/15/2025 8:49 AM DCASEY


PRELIMINARY ROAD IMPROVEMENTS STA 55+00 TO 60+00


OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON


0 10' 20' 40'
SCALE: 1"=20'

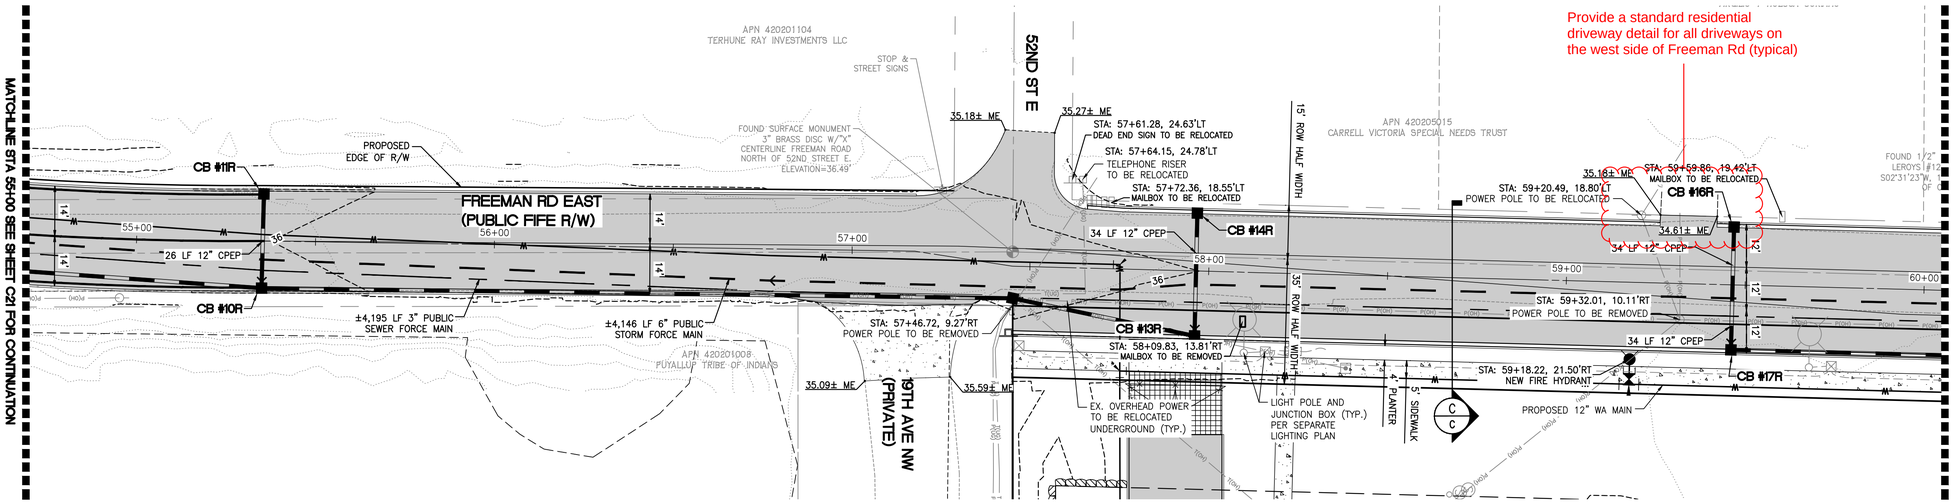

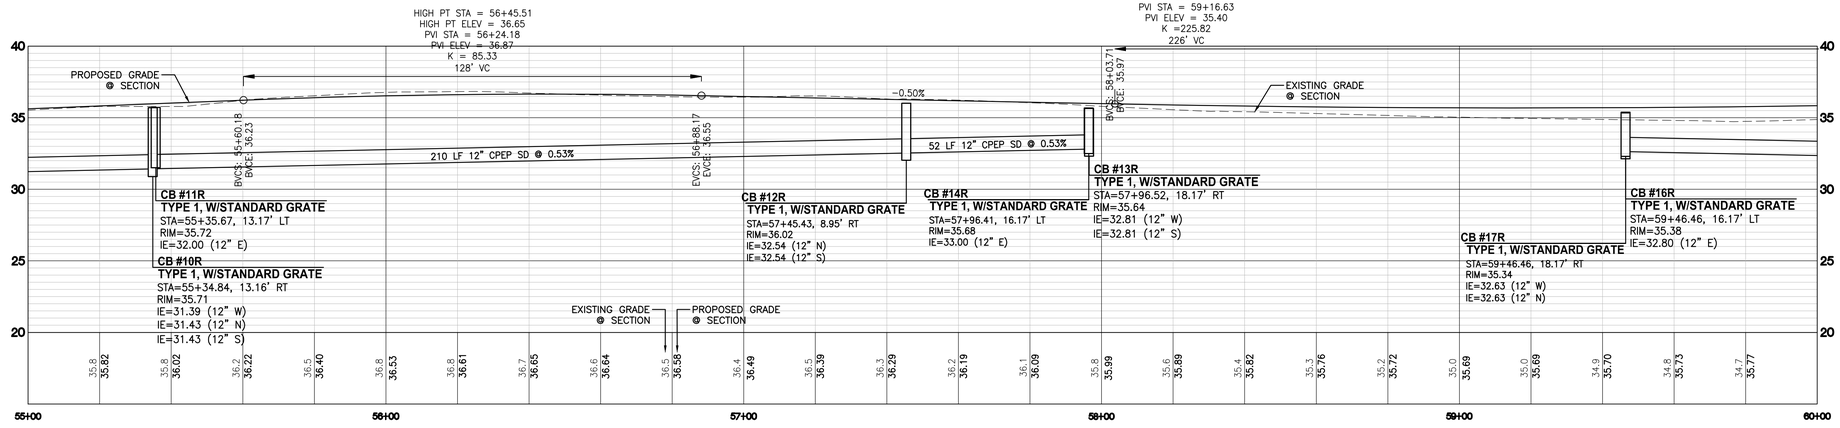

FREEMAN ROAD EAST ℄ STA: 55+00 TO 60+00

SCALE: HORIZ. 1"=20' VERT. 1"=5'

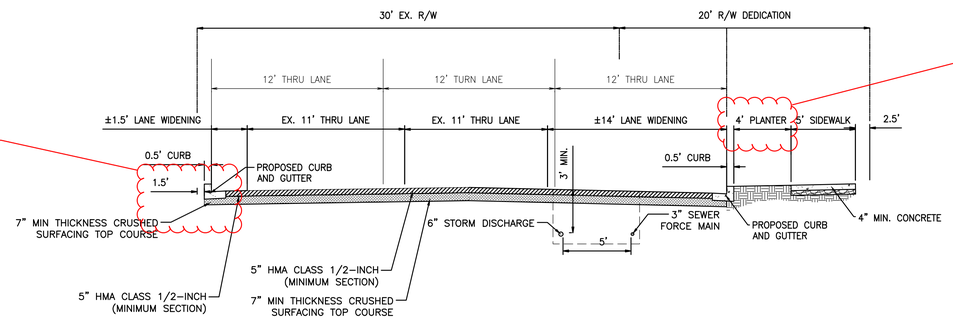

FREEMAN ROAD EAST SECTION C

NOT TO SCALE

FRONTAGE LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- SANITARY SEWER LINE
- SANITARY SEWER CLEANOUT
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS 150
- PROPOSED ASPHALT PAVEMENT
- EXISTING PAVEMENT

ENGINEER'S REVIEW — FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY ROAD IMPROVEMENTS STA 55+00 TO 60+00 FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCABEE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C22 of 48

P:\21000s\21585\engineering\SEPA SET\21585-R.dwg 7/15/2025 8:49 AM DCASEY


PRELIMINARY ROAD IMPROVEMENTS STA 60+00 TO 65+00


OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON


0 10' 20' 40'
SCALE: 1"=20'

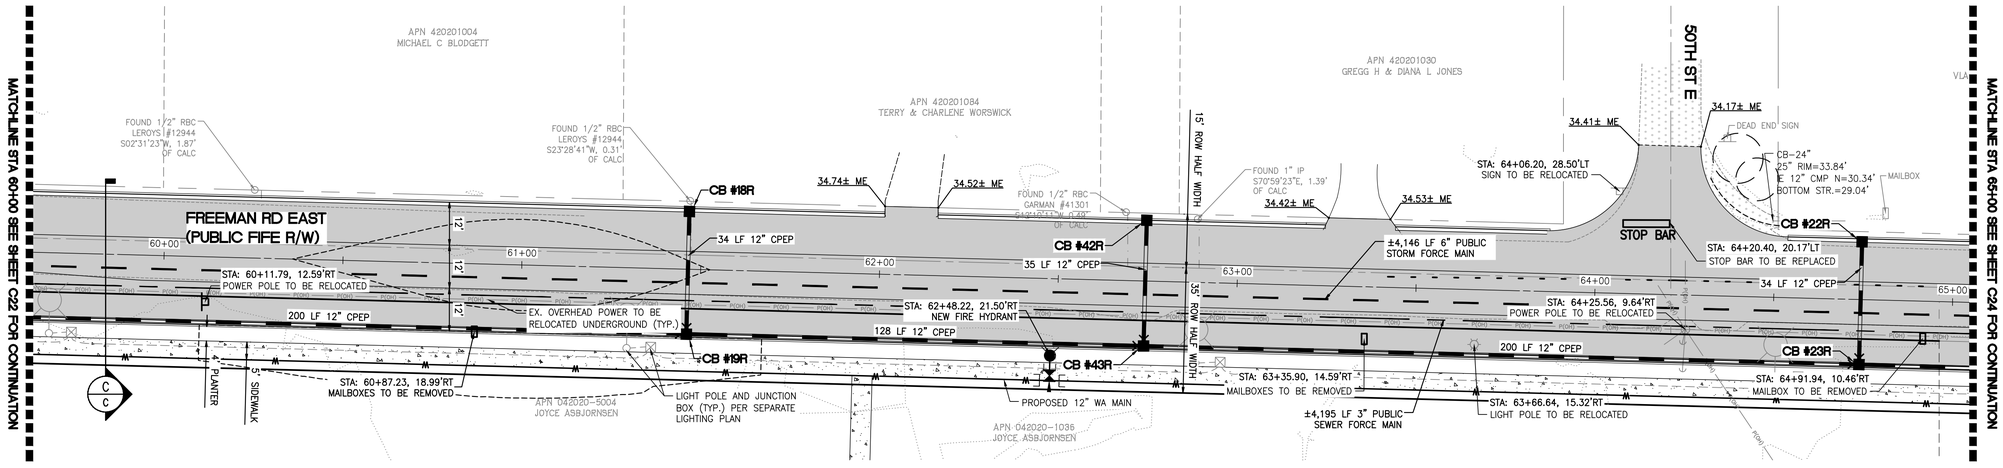

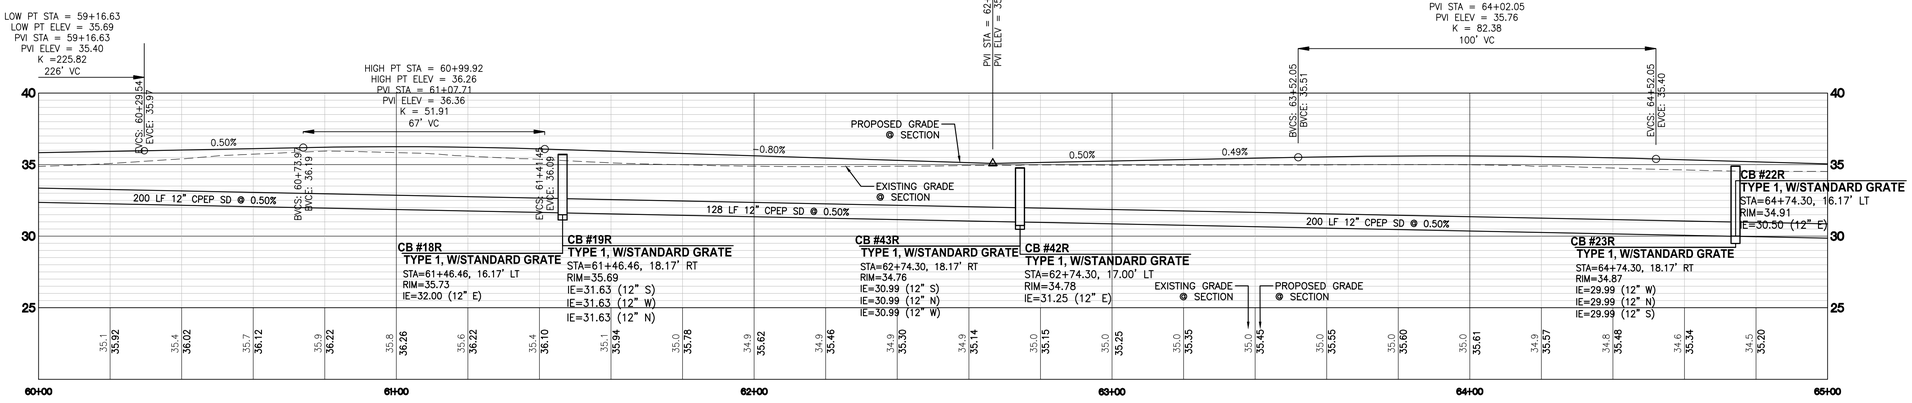

FREEMAN ROAD EAST ℄ STA: 60+00 TO 65+00

SCALE: HORIZ. 1"=20' VERT. 1"=5'

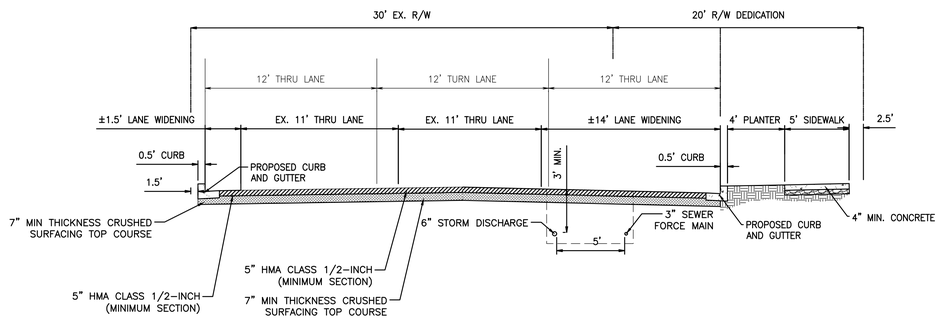

C/C FREEMAN ROAD EAST SECTION C

NOT TO SCALE

FRONTAGE LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- SANITARY SEWER LINE
- SANITARY SEWER CLEANOUT
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS 150
- PROPOSED ASPHALT PAVEMENT
- EXISTING PAVEMENT
- STORM FORCE MAIN
- WATER
- SEWER FORCE MAIN

ENGINEER'S REVIEW — FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:

THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY ROAD IMPROVEMENTS STA 60+00 TO 65+00 FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCAREE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C23 of 48

P:\21000s\21585\engineering\SEPA SET\21585-R.dwg 7/15/2025 8:49 AM DCASEY


PRELIMINARY ROAD IMPROVEMENTS STA 65+00 TO 70+00


OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON


0 10' 20' 40'
SCALE: 1"=20'

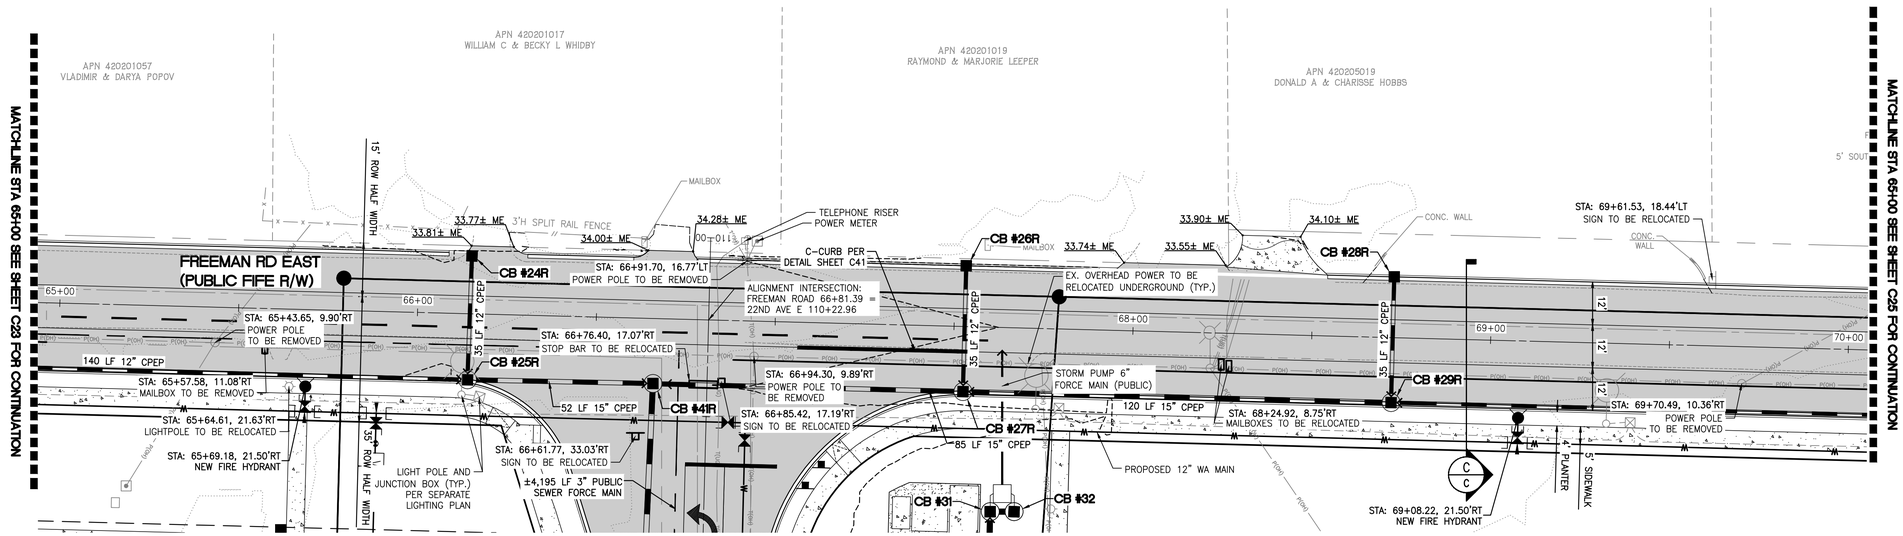

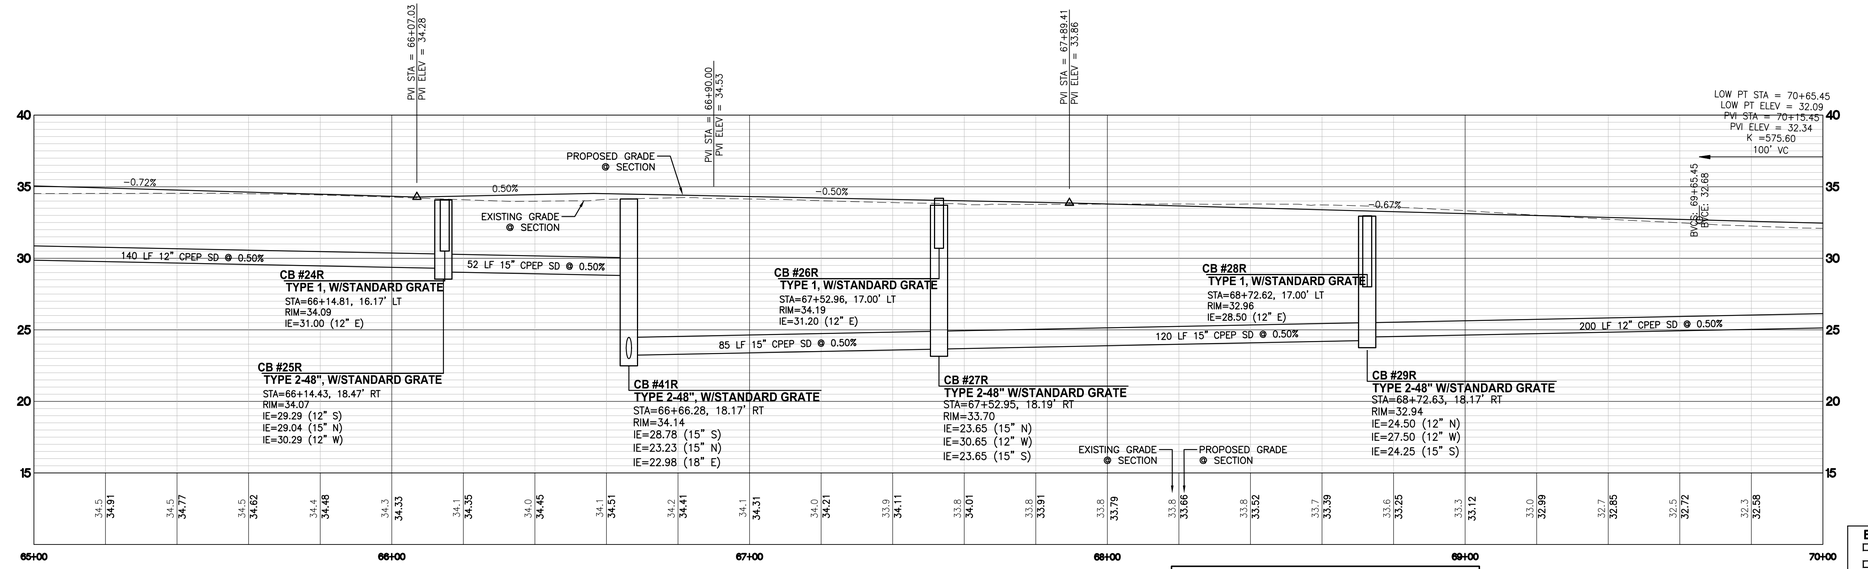

FREEMAN ROAD EAST ℄ STA: 65+00 TO 70+00

SCALE: HORIZ. 1"=20' VERT. 1"=5'

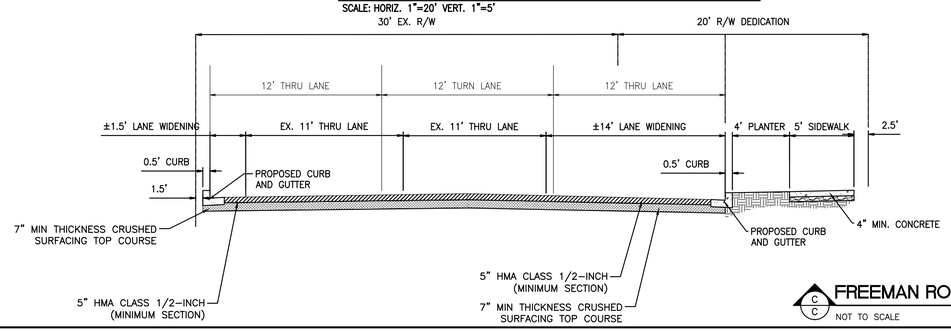

C/C FREEMAN ROAD EAST SECTION C
NOT TO SCALE

FRONTAGE LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- SANITARY SEWER LINE
- SANITARY SEWER CLEANOUT
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS 150
- PROPOSED ASPHALT PAVEMENT
- STORM FORCE MAIN
- SEWER FORCE MAIN

ENGINEER'S REVIEW FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY ROAD IMPROVEMENTS STA 65+00 TO 70+00 FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C24 of 48

P:\21000s\21585\engineering\SEPA SET\21585-R.dwg 7/15/2025 8:49 AM DCASEY


PRELIMINARY ROAD IMPROVEMENTS STA 70+00 TO 75+00


OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

0 10' 20' 40'
SCALE: 1"=20'

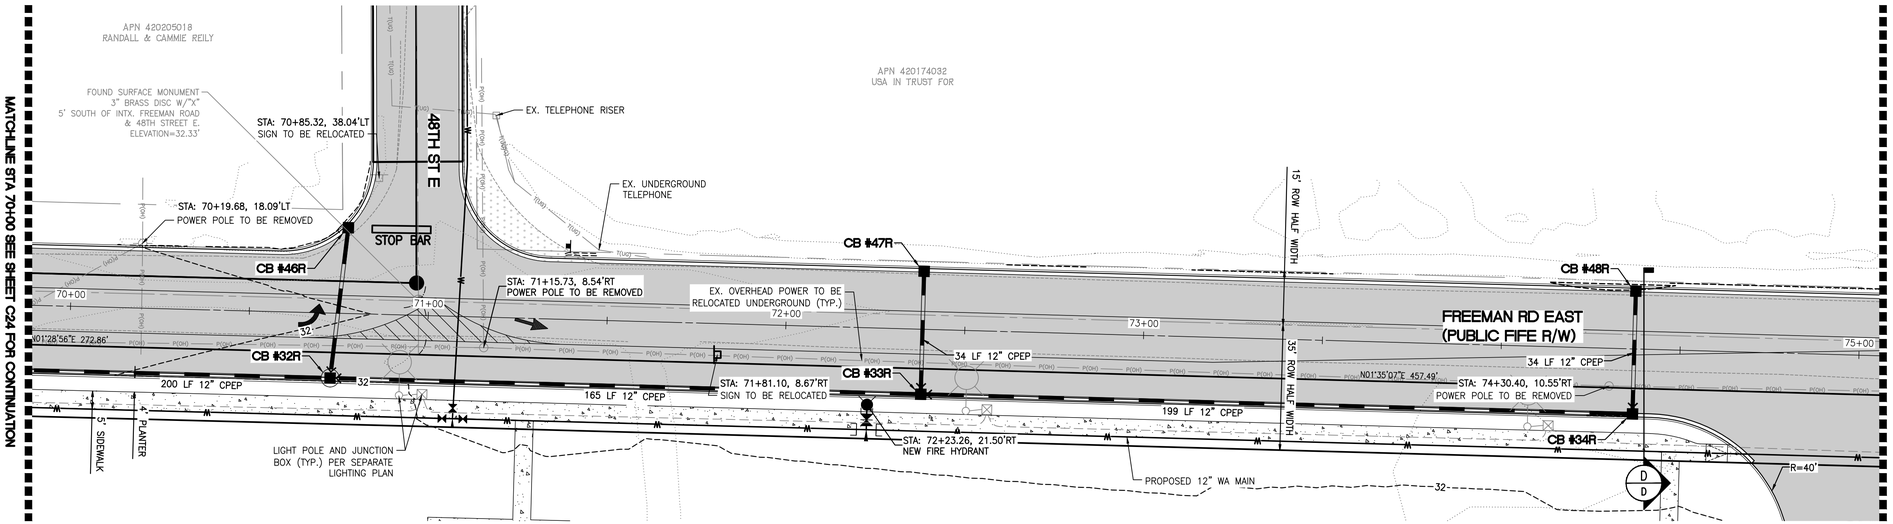


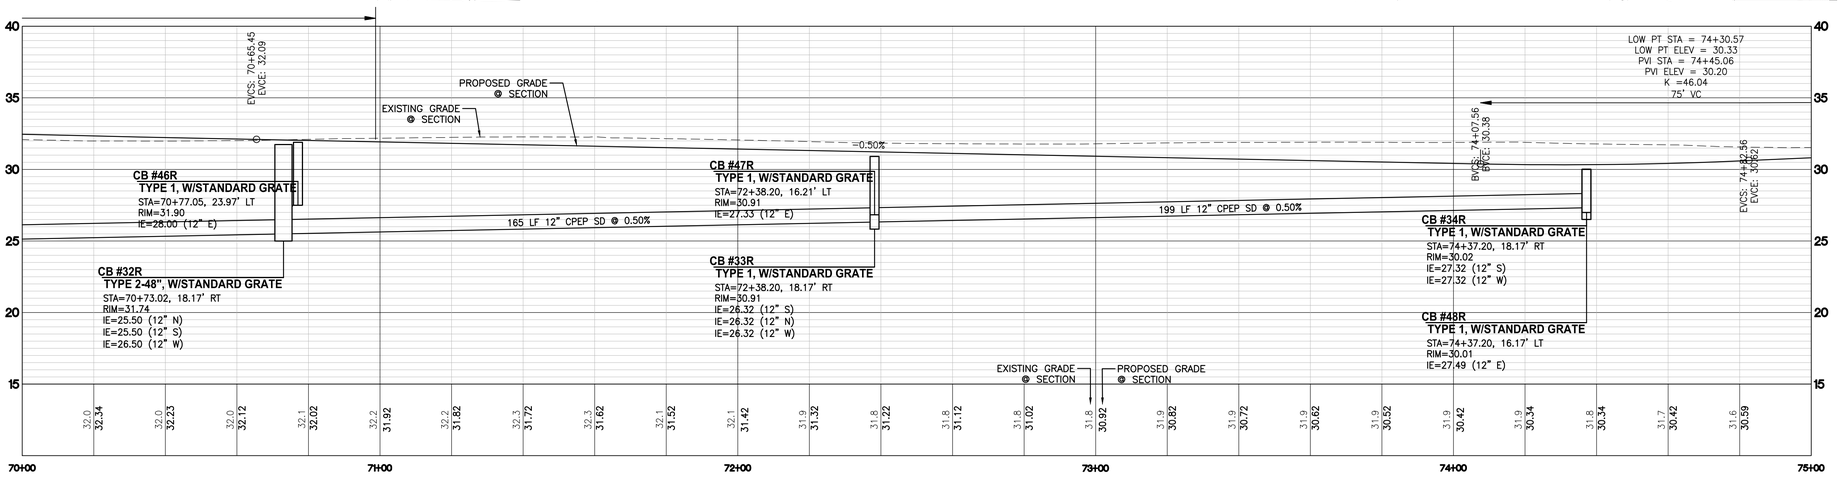

FREEMAN ROAD EAST ℄ STA: 70+00 TO 75+00

SCALE: HORIZ. 1"=20' VERT. 1"=5'

Edge protection may be required depending on wall height; who will be designing the wall?

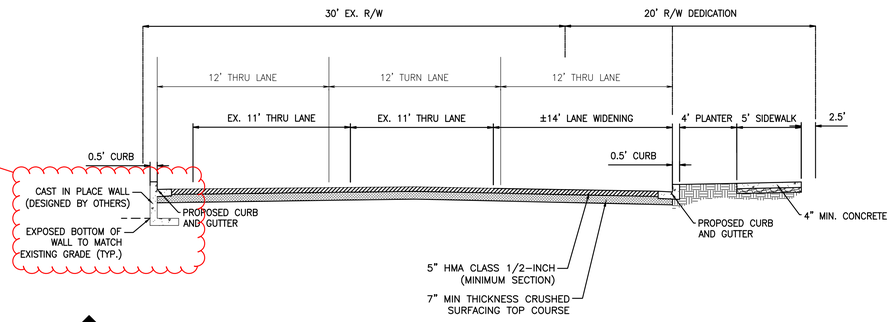

D/D FREEMAN ROAD EAST SECTION D

NOT TO SCALE

FRONTAGE LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- SANITARY SEWER LINE
- SANITARY SEWER CLEANOUT
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS 150
- PROPOSED ASPHALT PAVEMENT
- EXISTING PAVEMENT

ENGINEER'S REVIEW FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title:
PRELIMINARY ROAD IMPROVEMENTS
STA 70+00 TO 75+00
FOR
FREEMAN LOGISTICS

For:
VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

STATE OF WASHINGTON
JASON S. MCARDLE
54927
REGISTERED
PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen
Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C25 of 48

P:\21000s\21585\engineering\SEPA SET\21585-R.dwg 7/15/2025 8:49 AM DCASEY


PRELIMINARY ROAD IMPROVEMENTS STA 75+00 TO 77+20


OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON


0 10' 20' 40'
SCALE: 1"=20'

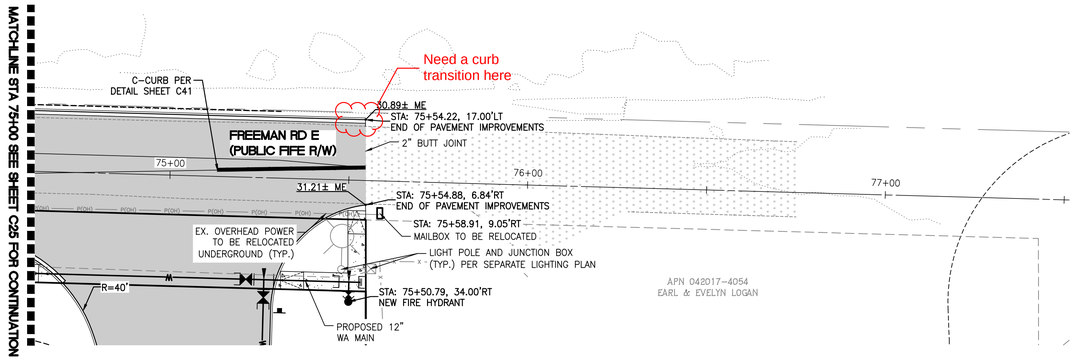

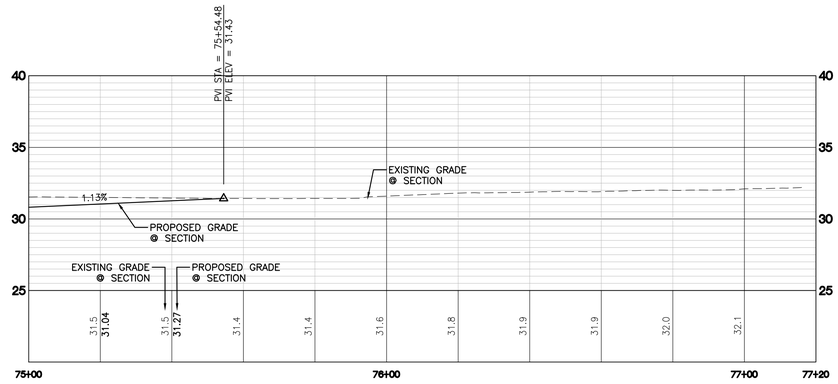

FREEMAN ROAD EAST ℄ STA: 75+00 TO 77+20

SCALE: HORIZ. 1"=20' VERT. 1"=5'

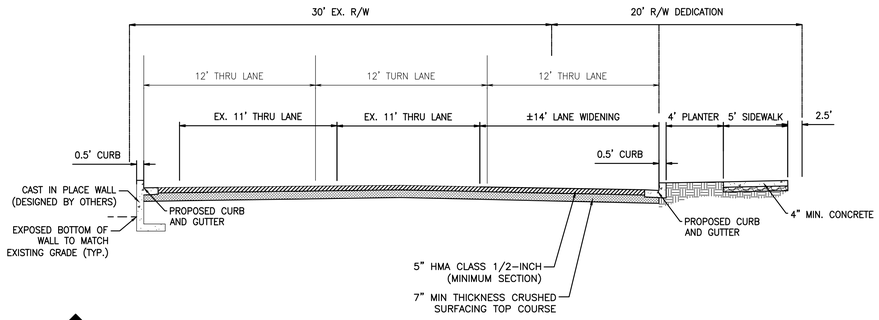

D/D FREEMAN ROAD EAST SECTION D

NOT TO SCALE

FRONTAGE LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- SANITARY SEWER LINE
- SANITARY SEWER CLEANOUT
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS ------150------
- PROPOSED ASPHALT PAVEMENT
- EXISTING PAVEMENT

ENGINEER'S REVIEW FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY ROAD IMPROVEMENTS STA 75+00 TO 77+20 FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCKINLEY — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C26 of 48

P:\21000s\21585\engineering\SEPA SET\21585-R.dwg 7/15/2025 8:49 AM DCASEY

PRELIMINARY ROAD IMPROVEMENTS 22ND AVE NW


OF


FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N


0 10' 20' 40'
SCALE: 1"=20'

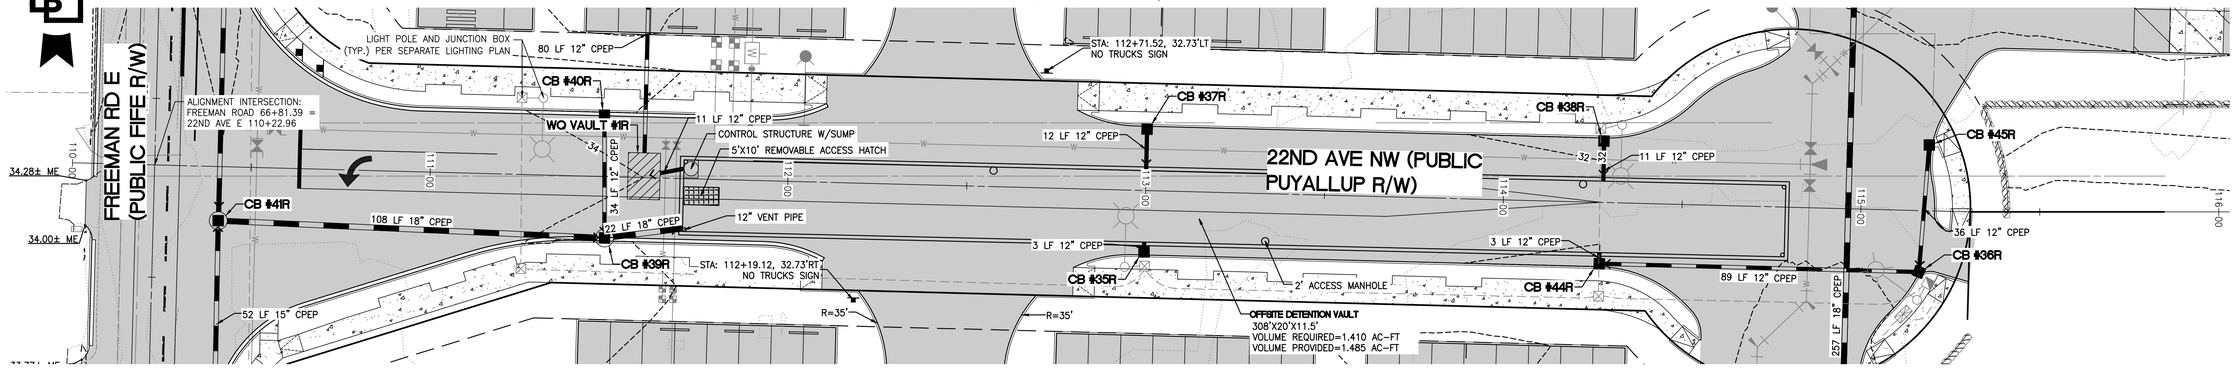

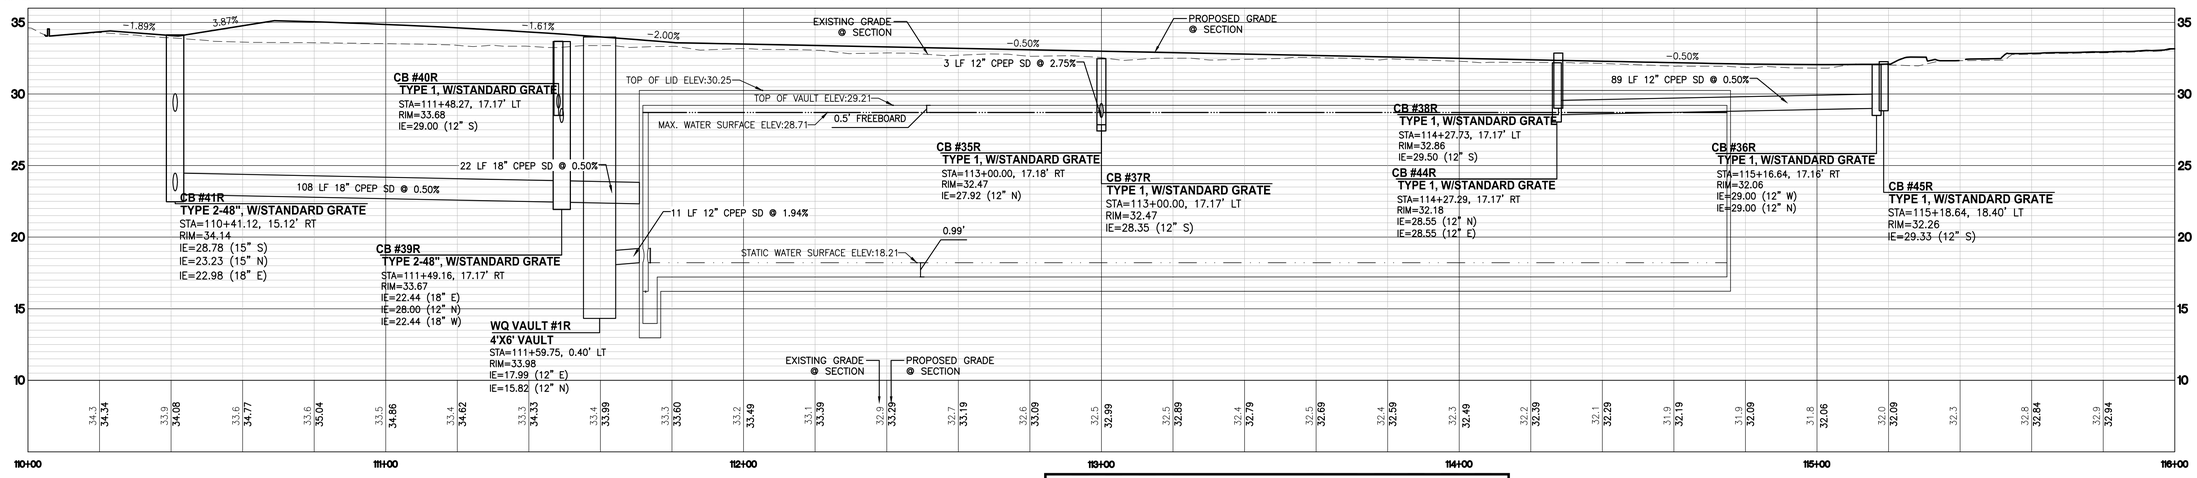

22ND AVE EAST ℄ STA: 110+00 TO 116+00

SCALE: HORIZ. 1"=20' VERT. 1"=5'

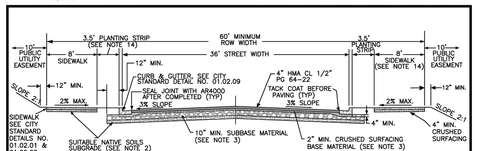

TYPE OF STREET	* MAXIMUM CENTERLINE GRADE	MINIMUM ROW WIDTH	MINIMUM STREET WIDTH	* MINIMUM PAVEMENT THICKNESS
COMMERCIAL COLLECTORS	10%	60'	36'	4"

*MINIMUM CENTERLINE AND FLOWLINE GRADES FOR ALL STREETS SHALL BE 0.5%
*MATCH EXISTING PAVEMENT THICKNESS IF GREATER THAN 4"

NOTES:

1. ALL DEPTHS ARE MINIMUM COMPACTED DEPTHS.
2. SUBGRADE PREPARATION SHALL MEET THE REQUIREMENTS OF WSDOT STANDARD SPEC. 2-06.3(1). IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO MEET THE COMPACTION REQUIREMENTS AND CONTROL ALL WORK. THE CITY OF PUYALLUP RESERVES THE RIGHT TO REQUIRE COMPLIANCE TESTS AT THE CONTRACTOR'S EXPENSE.
3. SUBBASE MATERIAL SHALL BE GRAVEL BORROW MEETING THE REQUIREMENTS OF WSDOT STANDARD SPEC. 9-03.14(1) OR CRUSHED BALLAST MEETING THE REQUIREMENTS OF WSDOT STANDARD SPEC. 9-03.9(1). CRUSHED SURFACING SHALL MEET THE GRADATION REQUIREMENTS OF WSDOT STANDARD SPEC. 9-03.9(3). THE SUBBASE AND BASE MATERIAL SHALL BE INSTALLED IN ACCORDANCE WITH WSDOT STANDARD SPEC. 4-04.
4. SOIL STABILIZATION FABRIC MAY BE REQUIRED BY THE DEVELOPMENT REVIEW ENGINEER TO BE INSTALLED PRIOR TO THE INSTALLATION OF THE BASE MATERIAL. WHEN REQUIRED, THE CONTRACTOR SHALL PLACE A GEOTEXTILE FABRIC OVER THE PREPARED SUBGRADE WITH A 2 FOOT MINIMUM OVERLAP. THE FABRIC SHALL BE INSTALLED PER MANUFACTURER SPECIFICATIONS.
5. ASPHALT CONCRETE PAVEMENT SHALL BE INSTALLED IN ACCORDANCE WITH WSDOT STANDARD SPEC. 5-04. DESIGN ENGINEER SHALL SUBMIT A STATE APPROVED HMA MIX FOR APPROVAL.
6. TEMPERATURE SHALL NOT EXCEED 325° F AT DISCHARGE OF THE PLANT NOR BE LESS THAN 185° F LEAVING THE SPREADER BOX.
7. THE MAXIMUM COMPACTED THICKNESS OF ANY SINGLE LIFT SHALL MEET WSDOT STANDARD SPEC. 5-04.3(9) TO A MINIMUM AVERAGE COMPACTED DRY DENSITY OF 91 PERCENT OF THE MAXIMUM DENSITY AS DETERMINED BY WSDOT TEST METHOD SPECIFIED IN STANDARD SPEC. 5-04.3(10)B. PERIODIC COMPLIANCE TESTS SHALL BE MADE BY A CERTIFIED TESTING AGENCY AT THE EXPENSE OF THE CONTRACTOR.
8. THE FACE OF THE GUTTER LIP AND EDGES OF EXISTING ASPHALT MEET LINES SHALL BE TACK COATED PRIOR TO PAVEMENT PLACEMENT. WHEN SUCCESSIVE LIFTS OF ASPHALT ARE REQUIRED, A TACK COAT SHALL BE DISTRIBUTED UNIFORMLY OVER THE PREVIOUS LIFT AT A RATE OF 0.06-0.08 GALLONS PER SQUARE YARD AT A TEMPERATURE OF 100° F AND SHALL BE ALLOWED TO SET TO A TACKY STATE PRIOR TO THE PLACEMENT OF THE NEXT LIFT.
9. ALL MEET LINES BETWEEN LIFTS OF ASPHALT SHALL BE UNIFORM AND VERTICAL. THE MEET LINES SHALL BE CLEANED AND TACK COATED.
10. ANY CHANGES TO THE STANDARD PAVEMENT SECTION SHALL REQUIRE APPROVAL BY THE DEVELOPMENT REVIEW ENGINEER. A STRUCTURAL PAVEMENT CROSS SECTION DESIGN WITH CALCULATIONS SHALL BE REQUIRED.
11. ALL MANHOLE FRAMES, VALVE FRAMES AND MONUMENT COVERS SHALL BE INSTALLED AFTER PLACEMENT OF ASPHALT. IF MORE THAN ONE LIFT IS NECESSARY, FRAMES AND LIDS WILL BE ADJUSTED TO FINISH GRADE AT FIRST LIFT AS DIRECTED BY THE CITY.
12. ADDITIONAL BIKE LANES AND/OR ON-STREET PARKING MAY BE REQUIRED PER TRAFFIC ENGINEER.
13. A UTILITY EASEMENT OF 10' SHALL BE PROVIDED ON BOTH SIDES OF THE ROADWAY.
14. WHEN PLANTING STRIP IS 5' IN WIDTH OR LESS, STREET TREE PLANTER BOXES SHALL BE INSERTED AT LOCATIONS AS REQUIRED BY THE CITY (REFER TO CITY STANDARD DETAIL NO. 01.02.04).
15. PLANTING STRIP SHALL BE PLANTED AS DIRECTED BY CITY PLANNING DEPARTMENT.

CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

36' PUBLIC ROADWAY COMMERCIAL COLLECTOR CROSS SECTION

DRAWN BY	DESIGNED BY	APPROVED BY	REVISED BY	CITY STANDARD
JSM/DWYN HYNDMAN	LINDA UAN	COLLEEN HARRIS	XXXX	
FILE NAME: P:\2100da\21585\engineering\DETECTY\20090501_STD01.01.01.01.04		DATE APPROVED: 03/01/2009	DATE REVISED: XX/XX/XX	SCALE: 1:10	01.01.04

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title:
PRELIMINARY ROAD
IMPROVEMENTS 22ND AVE NW
FOR
FREEMAN LOGISTICS

For:
VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCRAE
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen
Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C27 of 48

P:\2100da\21585\engineering\SEPA SET\21585-R.dwg 7/15/2025 8:49 AM DCASEY

PRELIMINARY ROAD IMPROVEMENTS 48TH ST STA 300+00 TO 301+00


OF


FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 10' 20' 40'
SCALE: 1"=20'

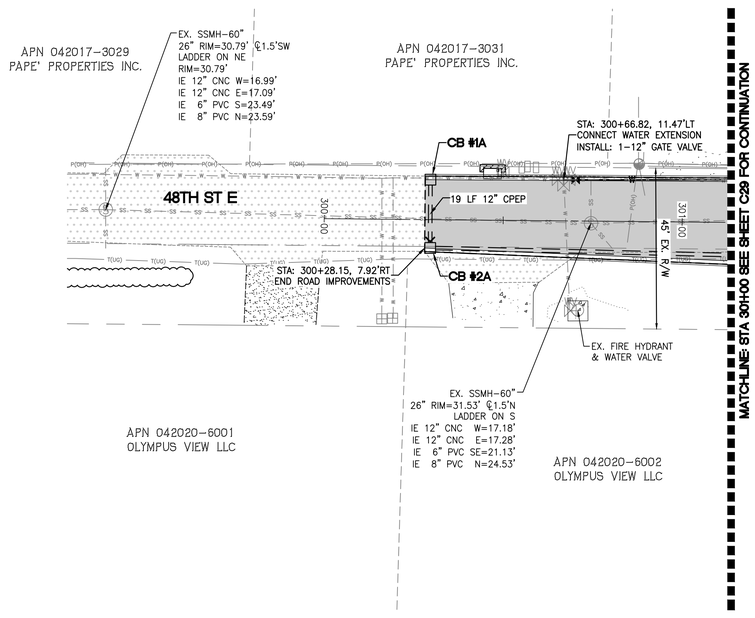


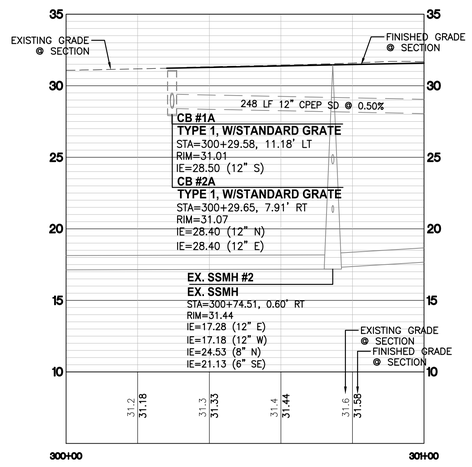

SHEETS C19 AND C28-C31 PROVIDED FOR REVIEW BY CITY OF FIFE FOR ALTERNATE SEWER CONNECTION AND WATER SYSTEM INTERTIE TO CITY OF PUYALLUP. CONCEPTUAL ROAD WIDENING AND STORMWATER SYSTEM ARE ALSO PROVIDED. THESE ALTERNATE IMPROVEMENTS ARE AT OWNER'S SOLE DISCRETION.

If this alternative is built, we'll need to see driveway details and tie-ins (typical)

The pavement section doesn't align with the recommendations from Terra Assoc. or past discussions

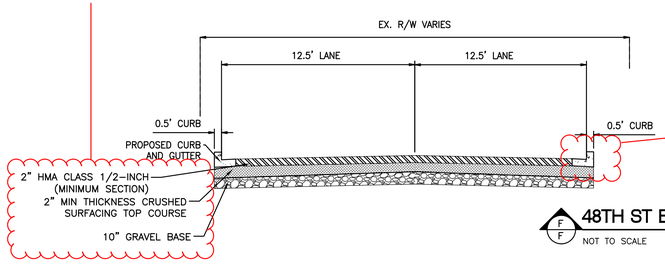

Show proposed edge treatment for both sides of the road; we'll expect a minimum 2' width of gravel; also, provide cross-sections every 25'

F F 48TH ST E SECTION F
NOT TO SCALE

48TH ST LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- SANITARY SEWER LINE
- SANITARY SEWER CLEANOUT
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS 150
- PROPOSED ASPHALT PAVEMENT
- EXISTING PAVEMENT

ENGINEER'S REVIEW FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY ROAD IMPROVEMENTS 48TH ST STA 300+00 TO 301+00 FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDELL — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C28 of 48

P:\21000s\21585\engineering\SEPA SET\21585-R-48TH.dwg 7/14/2025 3:06 PM DCASEY

PRELIMINARY ROAD IMPROVEMENTS 48TH ST STA 301+00 TO 307+00

OF


FREEMAN LOGISTICS


PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON


SHEETS C19 AND C28-C31 PROVIDED FOR REVIEW BY CITY OF FIFE FOR ALTERNATE SEWER CONNECTION AND WATER SYSTEM INTERTIE TO CITY OF PUYALLUP. CONCEPTUAL ROAD WIDENING AND STORMWATER SYSTEM ARE ALSO PROVIDED. THESE ALTERNATE IMPROVEMENTS ARE AT OWNER'S SOLE DISCRETION.

N

0 10' 20' 40'
SCALE: 1"=20'

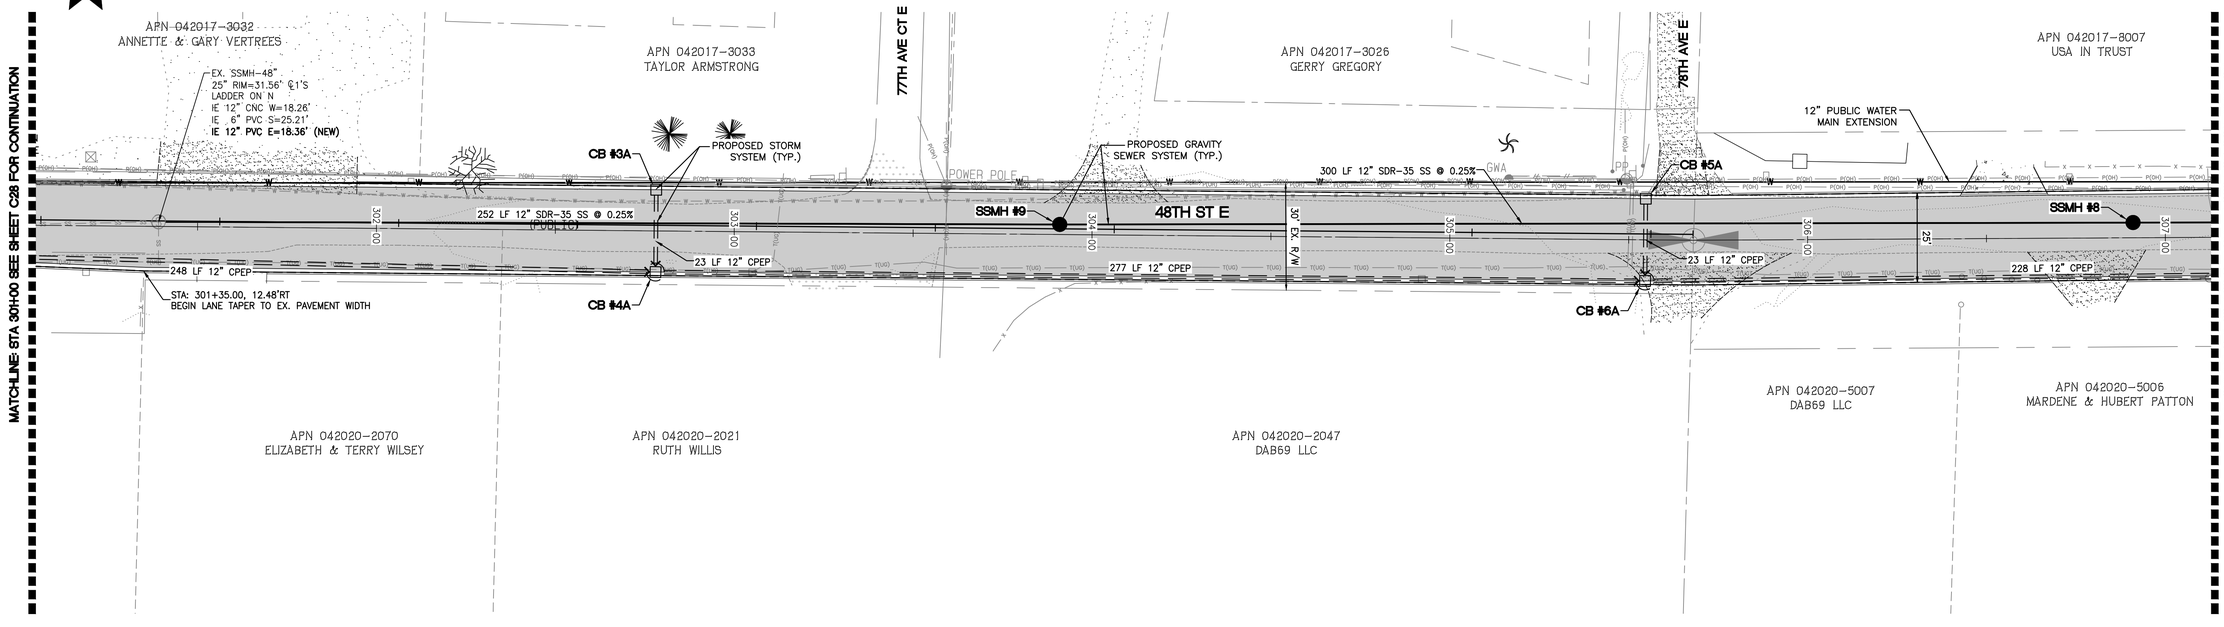

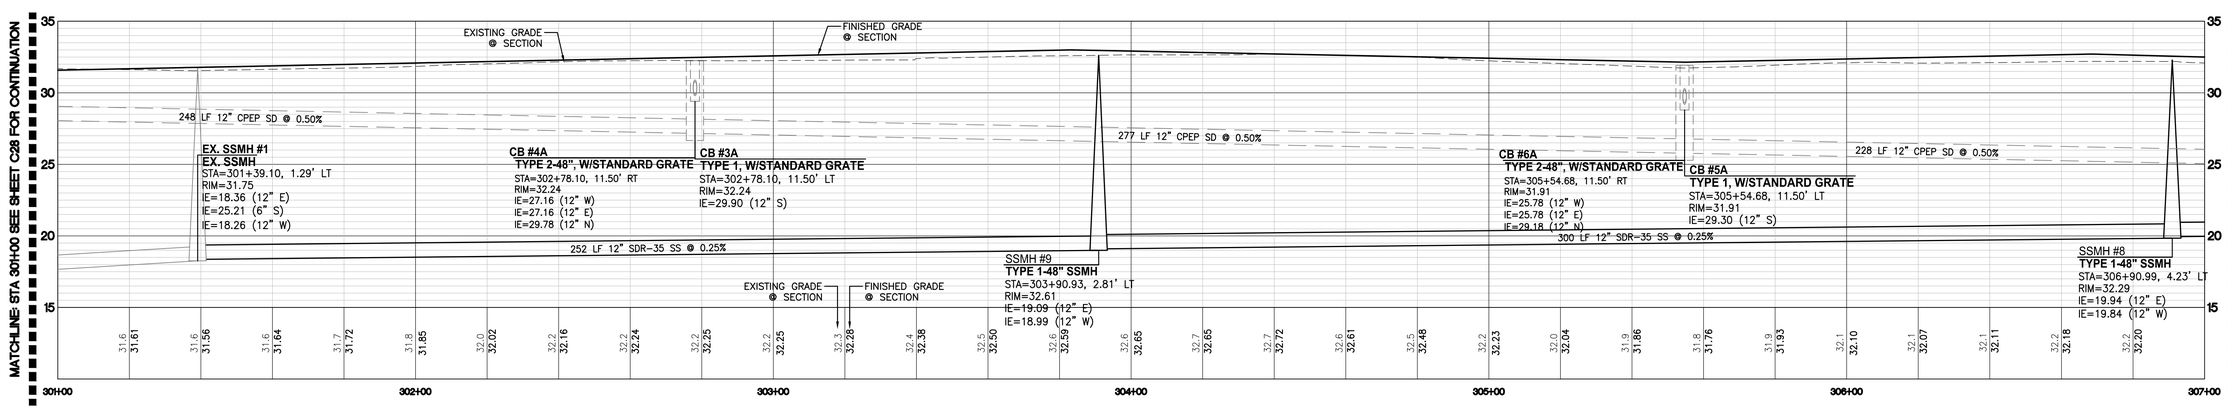

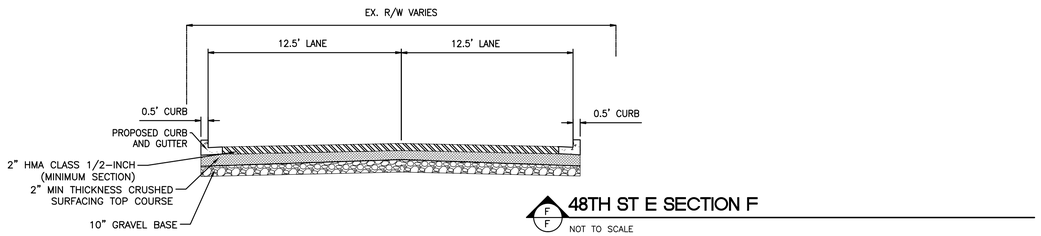

F F 48TH ST E SECTION F
NOT TO SCALE

48TH ST LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- SANITARY SEWER LINE
- SANITARY SEWER CLEANOUT
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS 150
- PROPOSED ASPHALT PAVEMENT
- EXISTING PAVEMENT

ENGINEER'S REVIEW — FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

No.	Date	By	Revision
6	07/16/25	DTC	SEPA RESUBMITTAL

Title: PRELIMINARY ROAD IMPROVEMENTS 48TH ST STA 301+00 TO 307+00 FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCADAMS — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C29 of 48

P:\21000s\21585\engineering\SEPA SET\21585-R-48TH.dwg 7/14/2025 3:06 PM DCASEY

PRELIMINARY ROAD IMPROVEMENTS 48TH ST STA 307+00 TO 313+00

OF


FREEMAN LOGISTICS


PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

SHEETS C19 AND C28-C31 PROVIDED FOR REVIEW BY CITY OF FIFE FOR ALTERNATE SEWER CONNECTION AND WATER SYSTEM INTERTIE TO CITY OF PUYALLUP. CONCEPTUAL ROAD WIDENING AND STORMWATER SYSTEM ARE ALSO PROVIDED. THESE ALTERNATE IMPROVEMENTS ARE AT OWNER'S SOLE DISCRETION.

N

0 10' 20' 40'
SCALE: 1"=20'

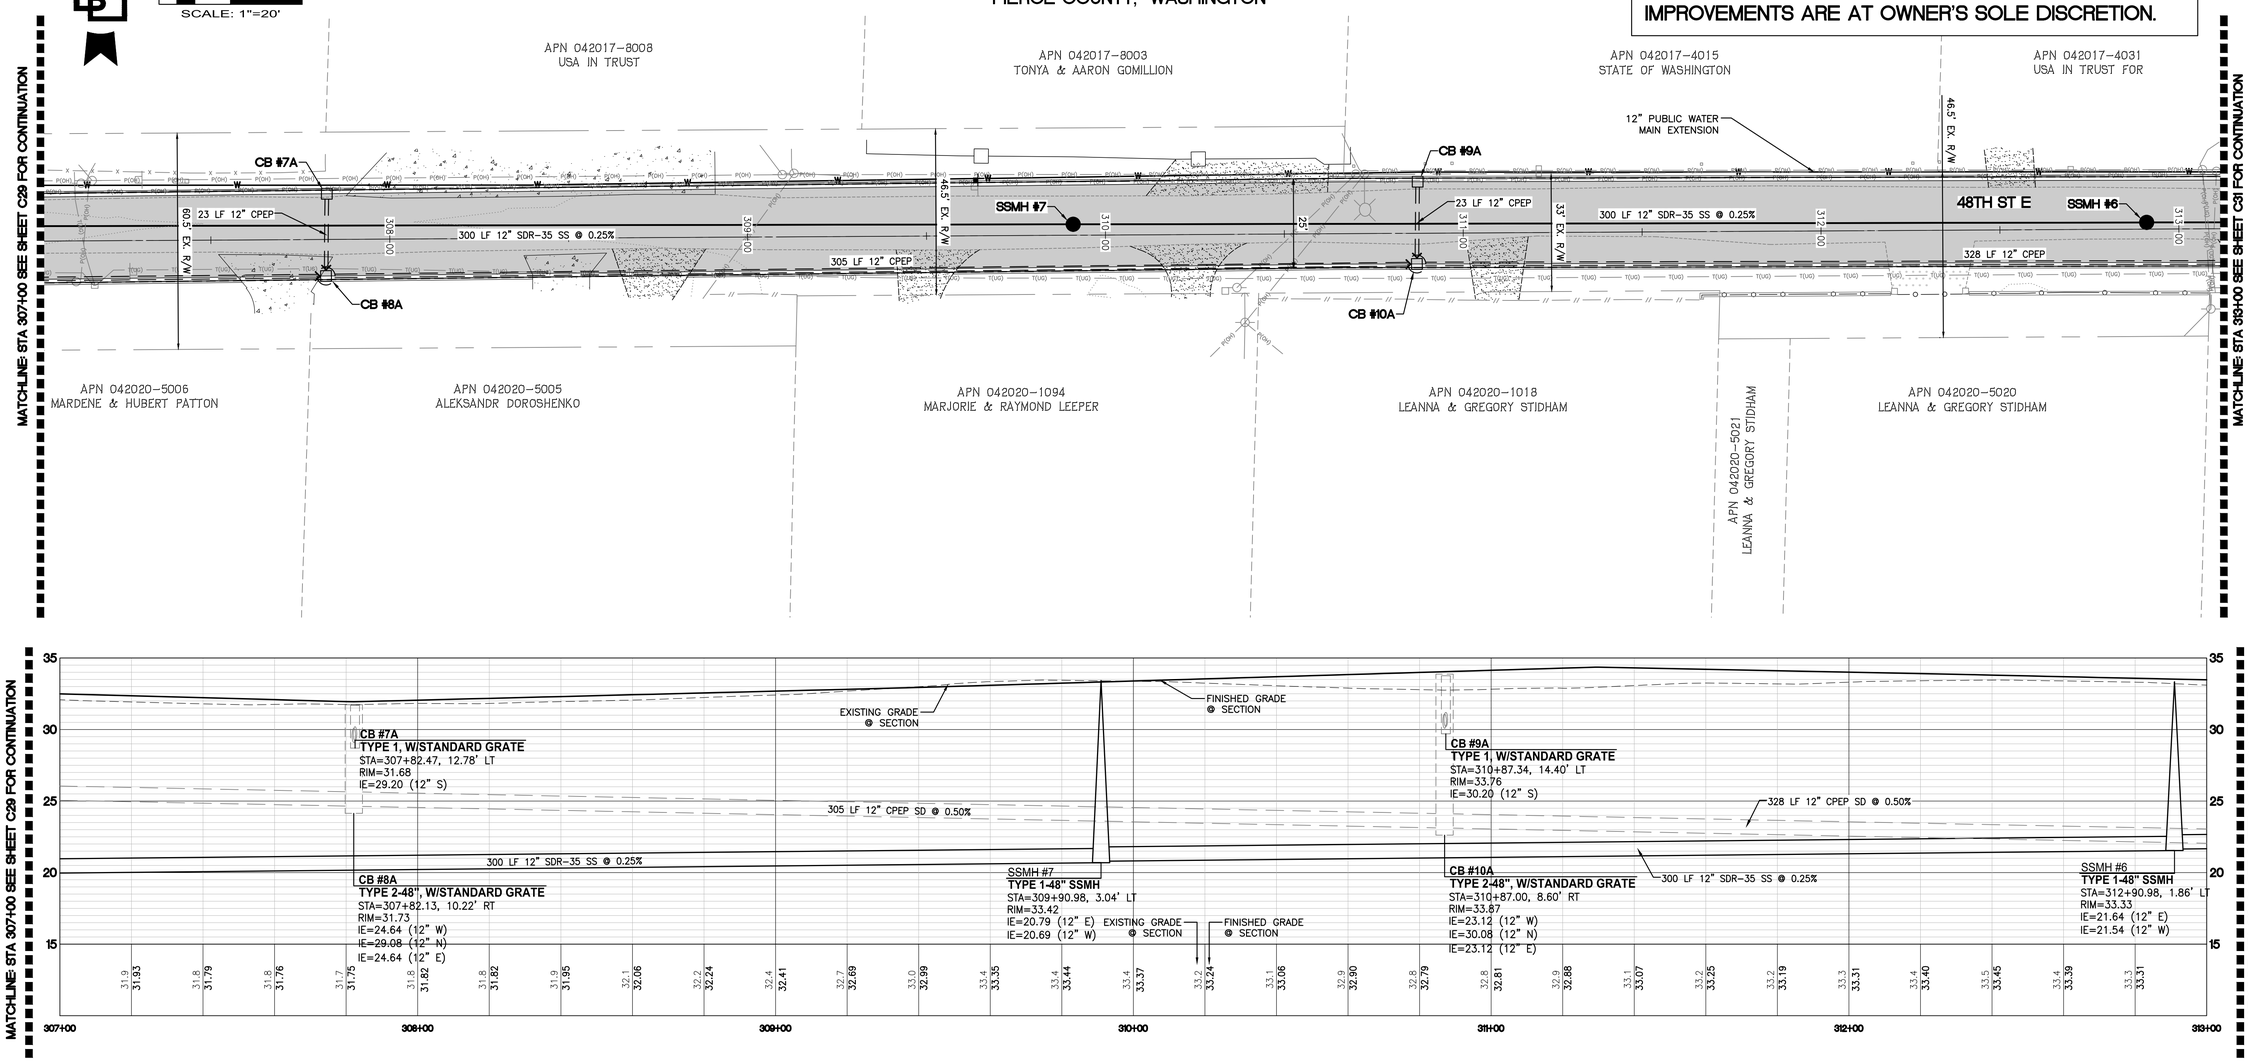

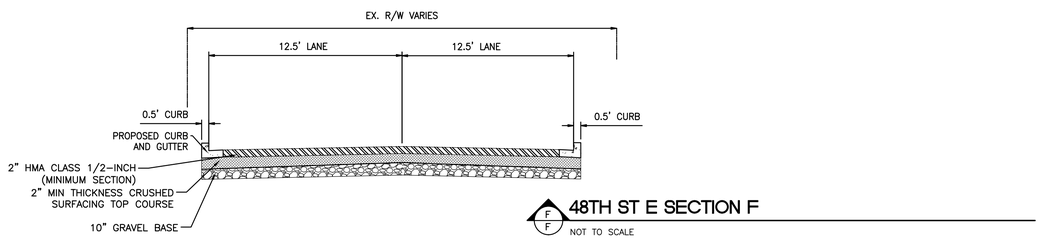

F F 48TH ST E SECTION F
NOT TO SCALE

48TH ST LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- SANITARY SEWER LINE
- SANITARY SEWER CLEANOUT
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS 150
- PROPOSED ASPHALT PAVEMENT
- EXISTING PAVEMENT

ENGINEER'S REVIEW — FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY ROAD IMPROVEMENTS 48TH ST STA 307+00 TO 313+00 FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDELL — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C30 of 48

P:\21000s\21585\engineering\SEPA SET\21585-R-48TH.dwg 7/14/2025 3:06 PM DCASEY

PRELIMINARY ROAD IMPROVEMENTS 48TH ST STA 313+00 TO 319+00

OF

FREEMAN LOGISTICS


PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON


SHEETS C19 AND C28-C31 PROVIDED FOR REVIEW BY CITY OF FIFE FOR ALTERNATE SEWER CONNECTION AND WATER SYSTEM INTERTIE TO CITY OF PUYALLUP. CONCEPTUAL ROAD WIDENING AND STORMWATER SYSTEM ARE ALSO PROVIDED. THESE ALTERNATE IMPROVEMENTS ARE AT OWNER'S SOLE DISCRETION.

If this alternative is constructed, recommend shifting the road a little to the south from Freeman Rd to approx. Sta. 310+00 to be provide a little more distance between the north back of curb and the ROW lines

N

0 10' 20' 40'
SCALE: 1"=20'

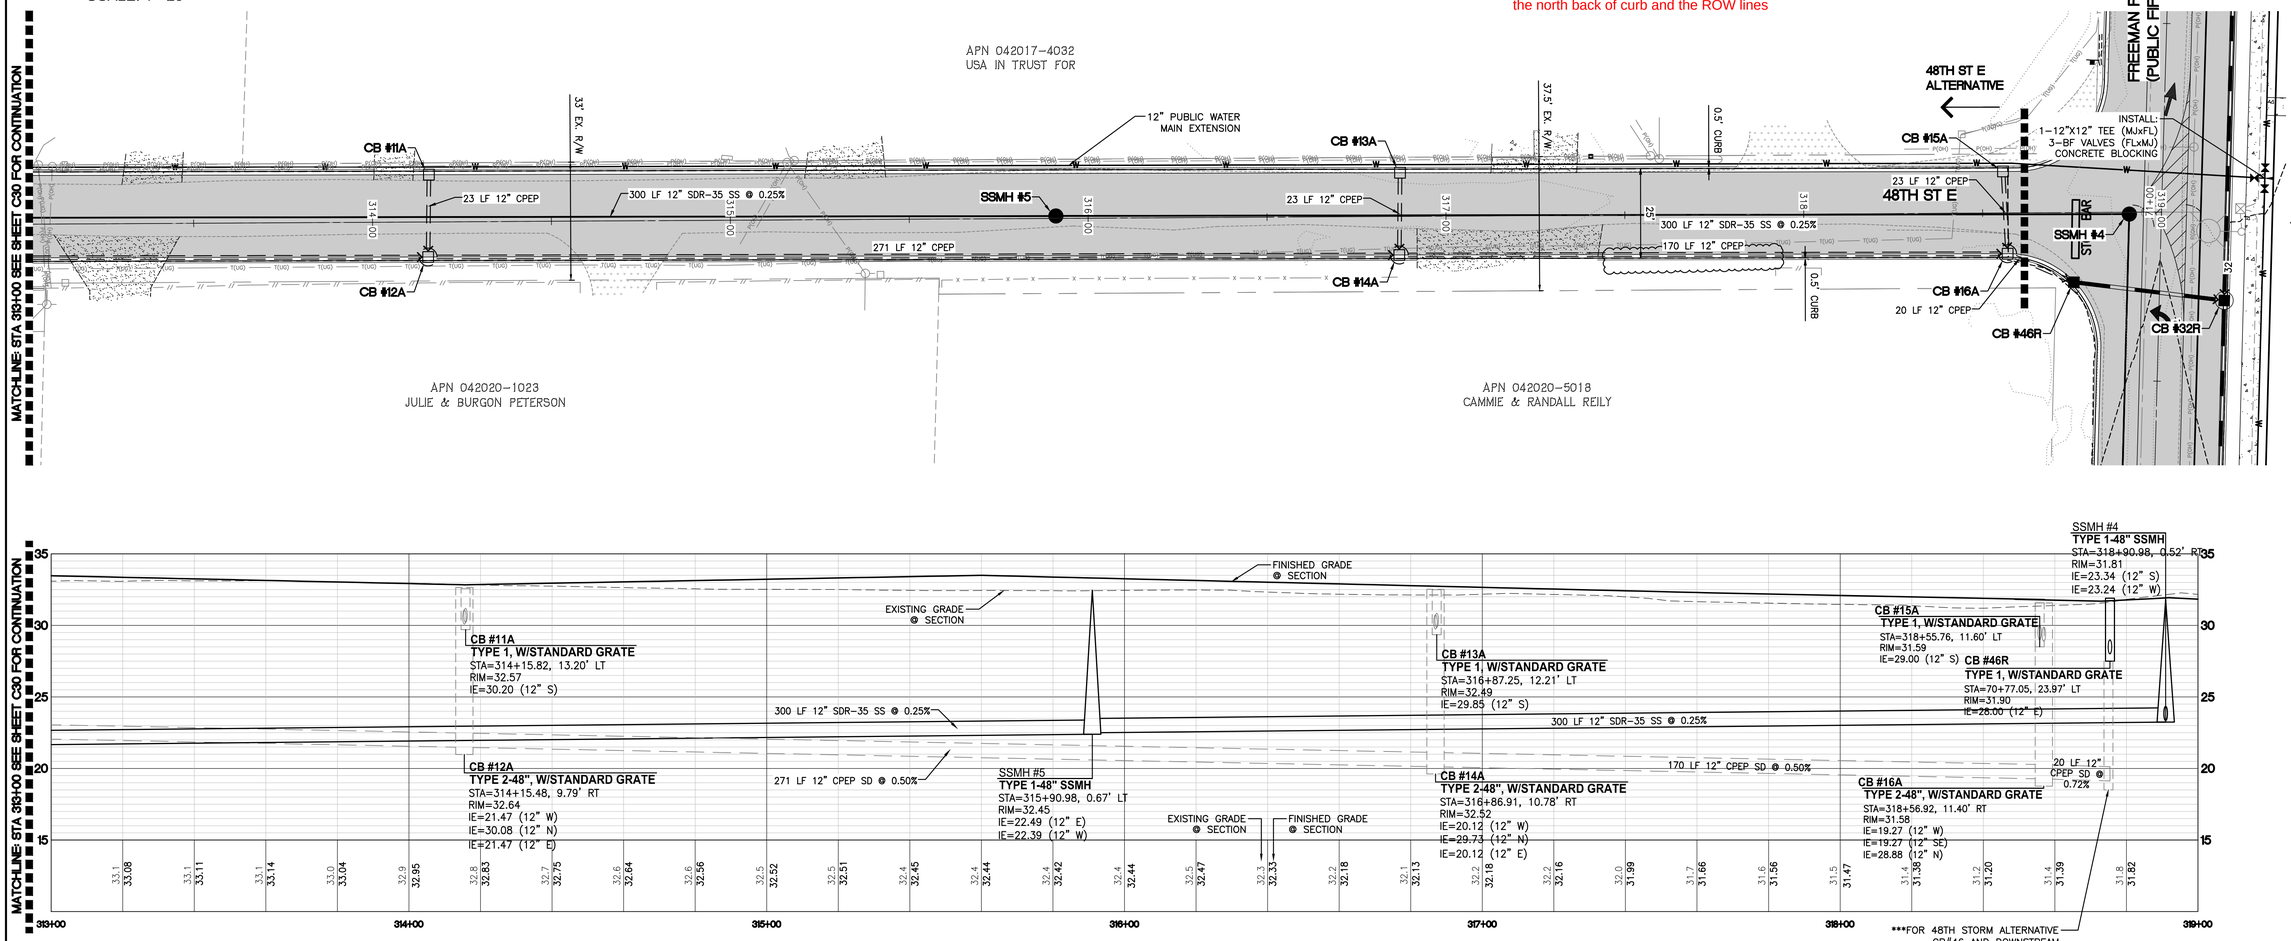

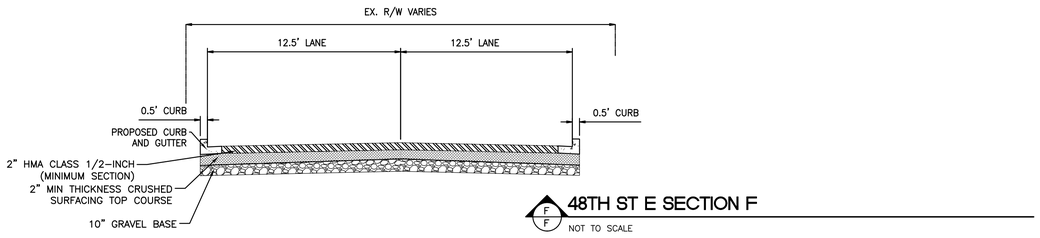

F F 48TH ST E SECTION F
NOT TO SCALE

48TH ST LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- SANITARY SEWER LINE
- SANITARY SEWER CLEANOUT
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS 150
- PROPOSED ASPHALT PAVEMENT
- EXISTING PAVEMENT

ENGINEER'S REVIEW — FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY ROAD IMPROVEMENTS 48TH ST STA 313+00 TO 319+00 FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical 1"=5'

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C31 of 48


P:\21000s\21585\engineering\SEPA SET\21585-R-48TH.dwg 7/14/2025 3:06 PM DCASEY

PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

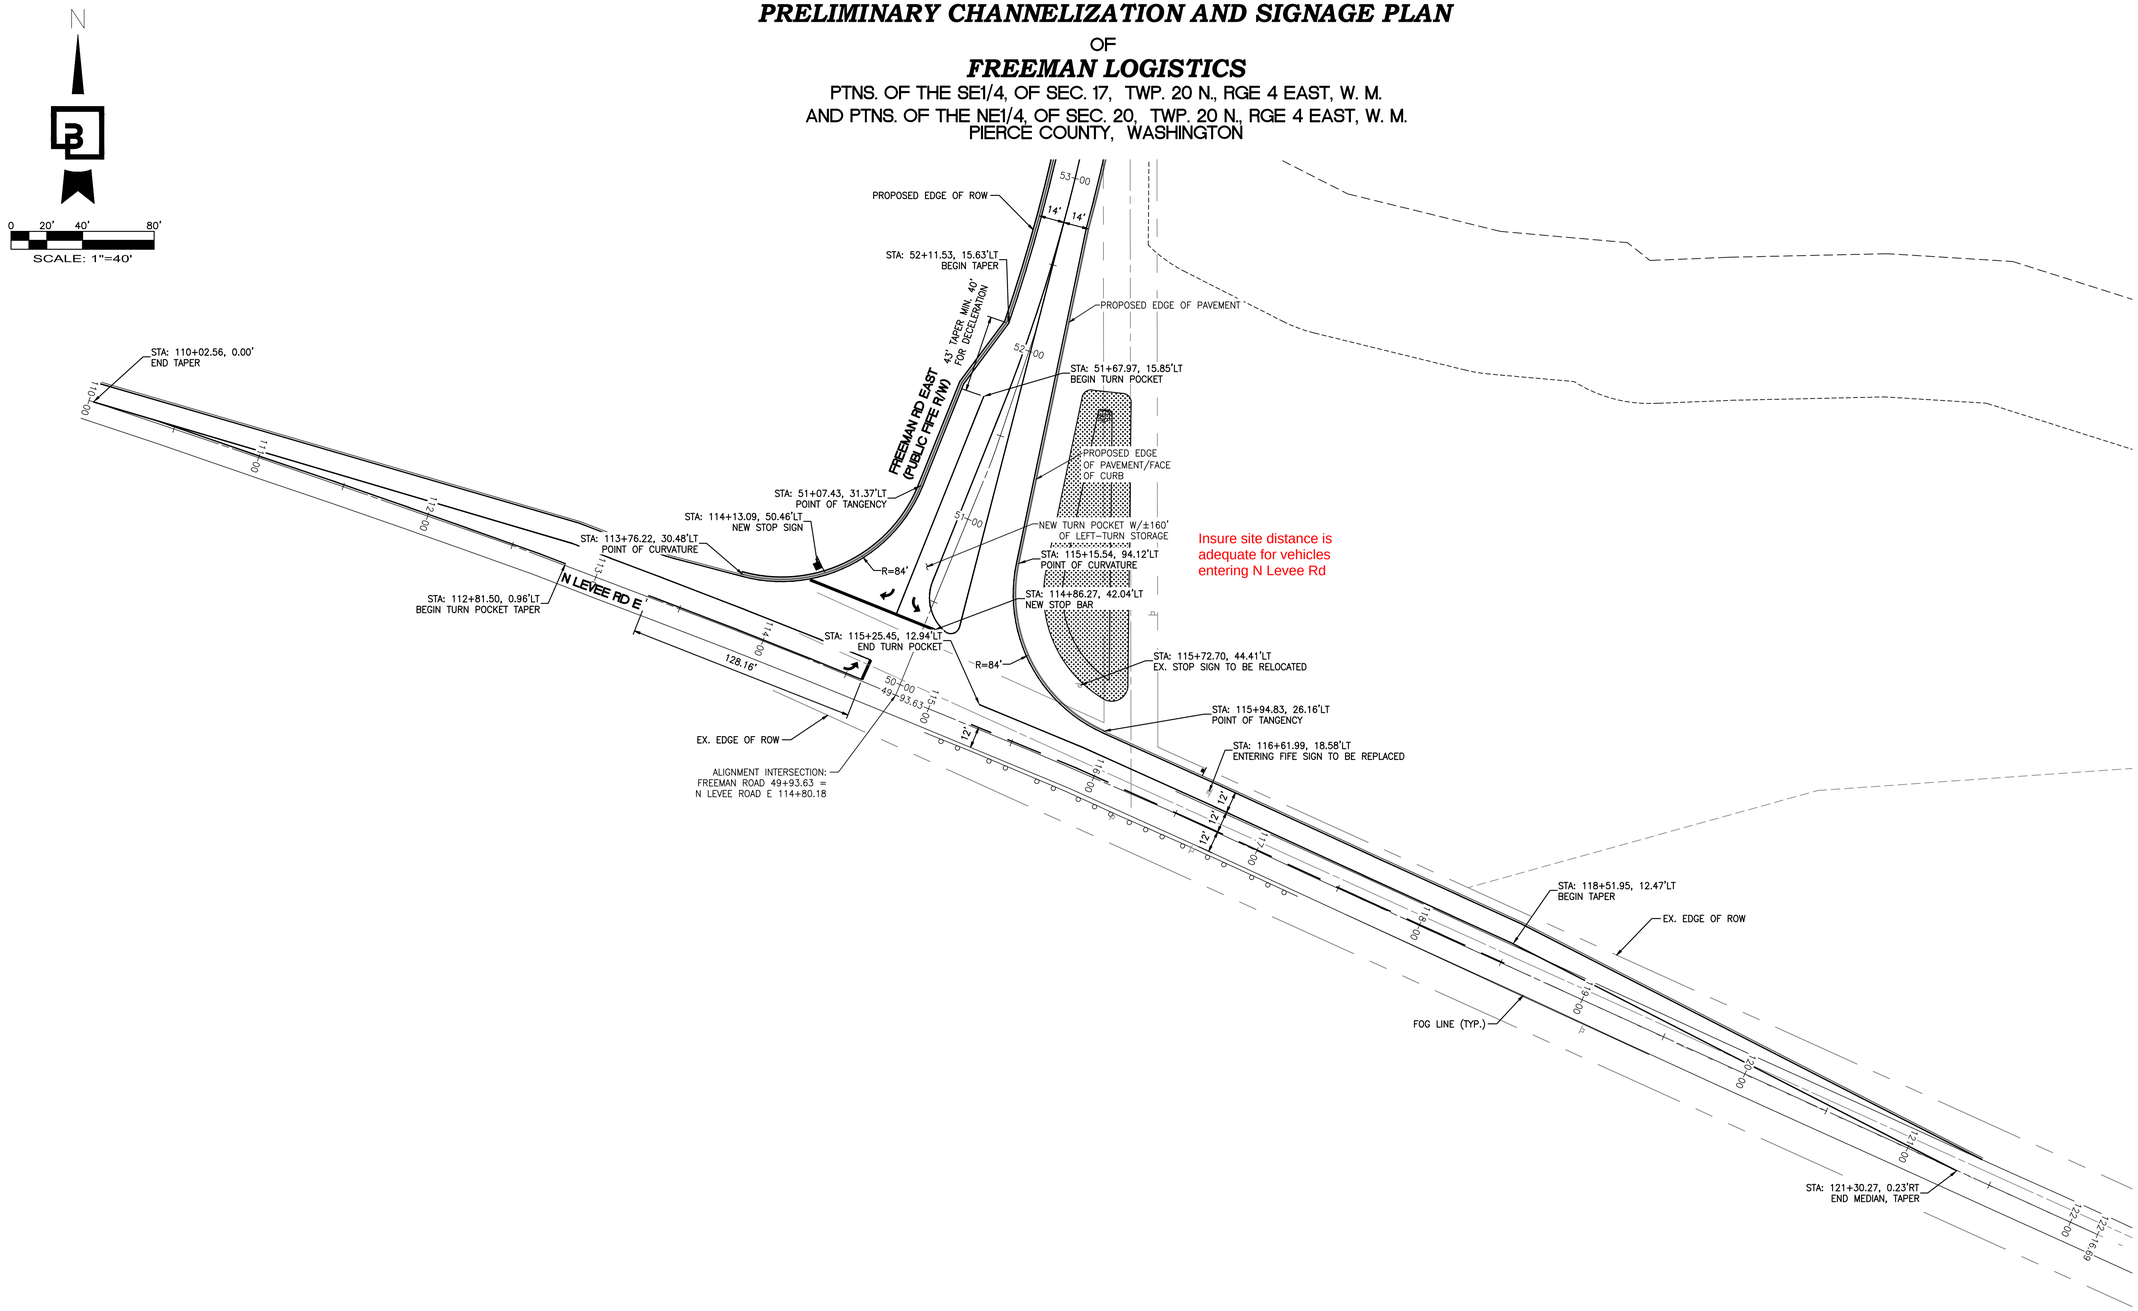

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH

ENGINEER'S REVIEW

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. JACOBSEN
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=40' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C32 of 48

P:\21000s\21585\engineering\SEPA SET\21585-C.dwg 7/16/2025 10:52 AM DCASEY

PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN STA 50+00 TO 60+00

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

0 10' 20' 40'
SCALE: 1"=20'

20'-0"

N LEVEE RD E

END TURN POCKET CHANNELIZATION
STA: 50+06.48, 45.29'RT

BEGIN LANE TAPER
STA: 52+11.53, 15.63'LT

BEGIN TURN POCKET TAPER
STA: 52+52.60, 0.00'

STA: 51+67.97, 15.85'LT
BEGIN TURN POCKET

PROPOSED
EDGE OF R/W

FREEMAN RD EAST (PUBLIC FIFE R/W)

0.5' CURB (TYP.)

FOG LINE (TYP.)

STOP SIGN TO BE REMOVED
AND REPLACED

30'-0"

WEIGHT LIMIT SIGN TO
BE REMOVED AND REPLACED
AS NECESSARY

STA: 50+09.77, 182.56'RT
ENTERING FIFE SIGN TO BE RELOCATED

STA: 50+19.64, 174.93'RT
RELOCATED SIGN LOCATION

MATCHLINE STA 55+00 BELOW FOR CONTINUATION

MATCHLINE STA 55+00 ABOVE FOR CONTINUATION

APN 420201104
TERHUNE RAY INVESTMENTS LLC

52ND ST E

POINT OF TANGENCY
STA: 57+37.38, 37.39'LT

POINT OF TANGENCY
STA: 57+55.97, 37.59'LT

RELOCATED DEAD END SIGN
STA: 57+62.39, 27.07'LT

DEAD END SIGN TO BE RELOCATED
STA: 57+61.28, 24.63'LT

RELOCATED STOP SIGN
STA: 57+22.28, 20.97'LT

STOP SIGN TO BE RELOCATED
STA: 57+22.73, 18.01'LT

R=25'

STOP BAR

POINT OF CURVATURE
STA: 57+17.37, 15.49'LT

POINT OF CURVATURE
STA: 57+75.96, 17.00'LT

STOP BAR TO BE REPLACED
STA: 57+34.59, 20.14'LT

15' ROW HALF WIDTH

APN 420205015
CARRELL VICTORIA SPECIAL NEEDS TRUST

245'
MIN. TAPER LENGTH = (WS^2)/60
WHERE W IS THE OFFSET CENTER
LANE WIDTH, S IS THE DESIGN
SPEED FOR S < 45 MPH
USE 245-FT MIN.

FOUND 1/2"
LEROYS
S02°31'23"

PROPOSED
EDGE OF R/W

FREEMAN RD EAST
(PUBLIC FIFE R/W)

14'
14'

FOG LINE (TYP.)

BEGIN LANE TAPER
STA: 57+48.68, 5.00'LT

35' ROW HALF WIDTH

END TURN LANE TAPER
STA: 59+93.68, 7.00'RT

FOUND SURFACE MONUMENT
4" BRASS DISC W/"X"
CENTERLINE FREEMAN ROAD
NORTH OF 52ND STREET E
ELEVATION=36.99'

APN 420201008
PUYALLUP TRIBE OF INDIANS

19TH AVE NW
(PRIVATE)

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH

ENGINEER'S REVIEW

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN STA 50+00 TO 60+00 FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCAREE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C33 of 48

P:\21000s\21585\engineering\SEPA SET\21585-C.dwg 7/16/2025 10:52 AM DCASEY


PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN STA 60+00 TO 70+00

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

0 10' 20' 40'
SCALE: 1"=20'

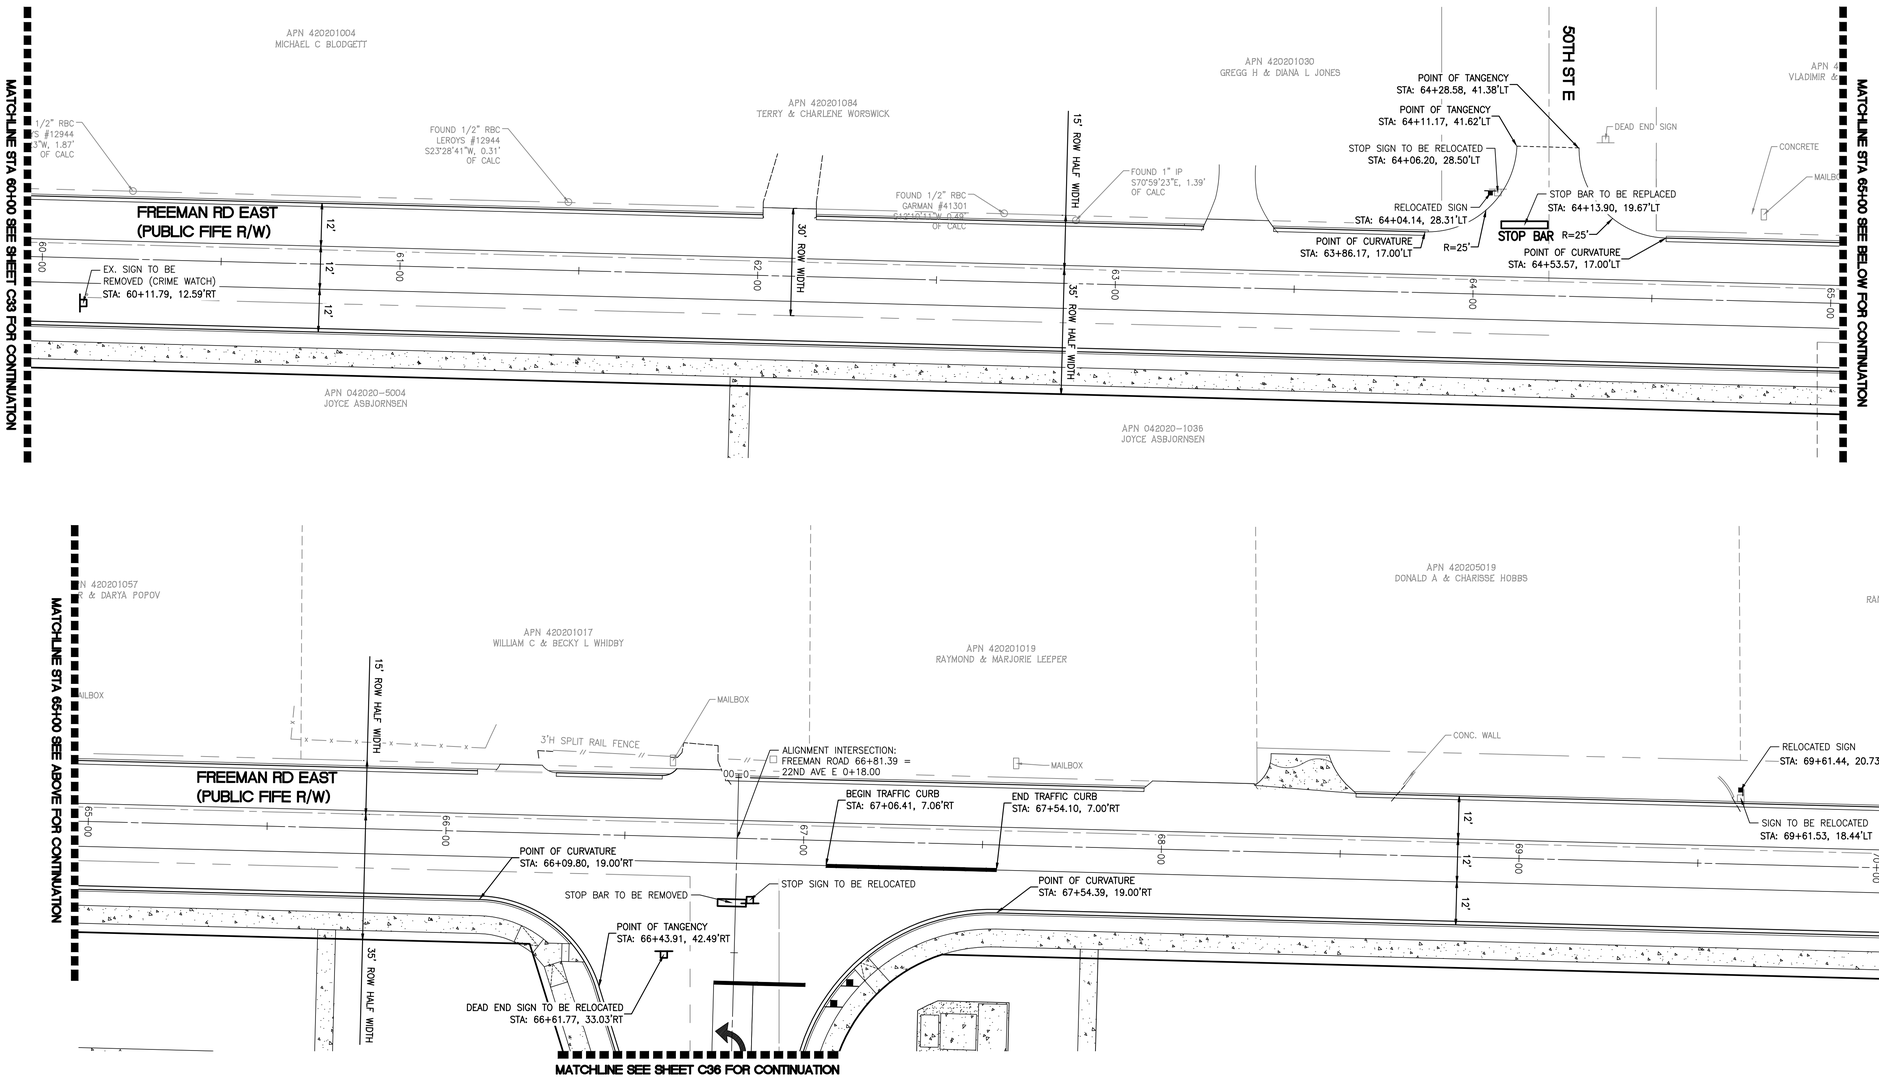

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH

ENGINEER'S REVIEW

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN STA 60+00 TO 70+00 FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. LACKEY — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical N/A
Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Job Number 21585
Sheet C34 of 48

P:\21000s\21585\engineering\SEPA SET\21585-C.dwg 7/16/2025 10:52 AM DCASEY

PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN STA 70+00 TO 77+20


OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 10' 20' 40'
SCALE: 1"=20'

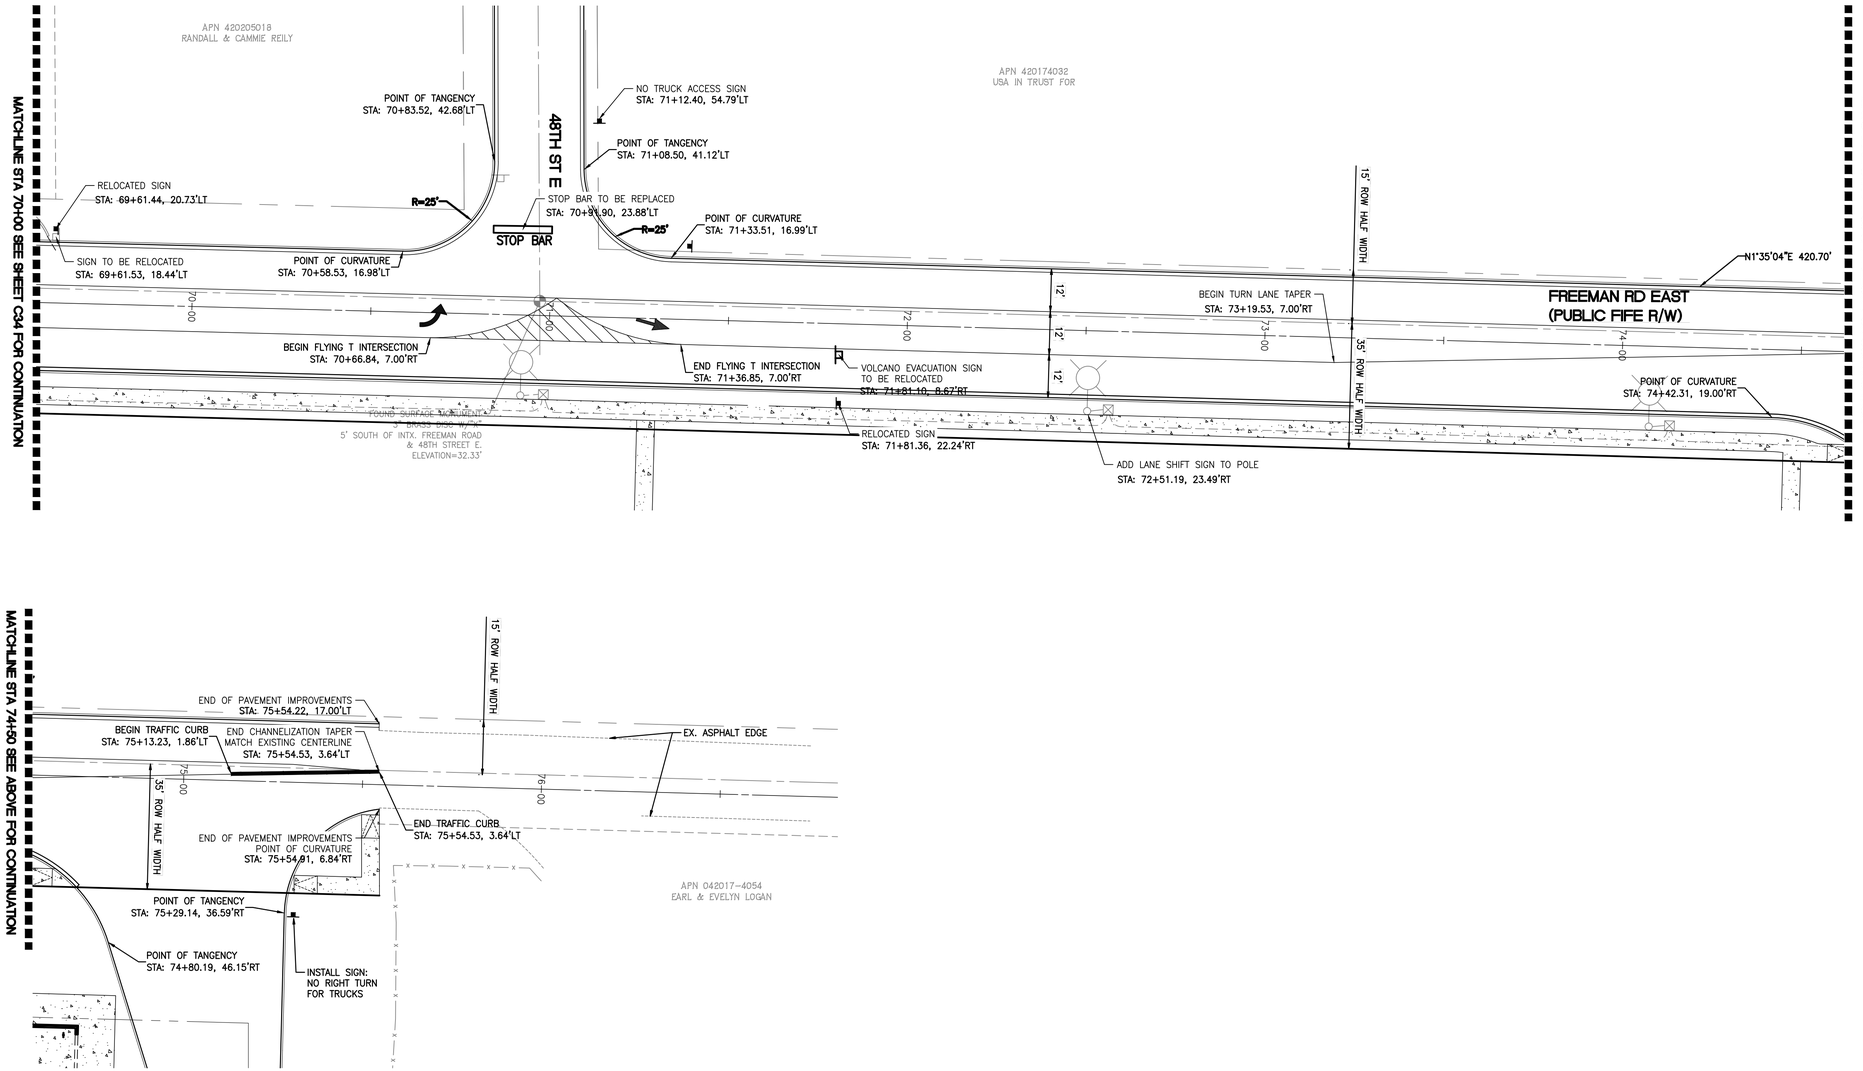

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH

ENGINEER'S REVIEW FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title:
PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN STA 70+00 TO 77+20
FOR
FREEMAN LOGISTICS

For:
VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDELL
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen
Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C35 of 48

P:\21000s\21585\engineering\SEPA SET\21585-C.dwg 7/16/2025 10:52 AM DCASEY

PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN 22ND AVE NW


OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON


N

0 10' 20' 40'
SCALE: 1"=20'

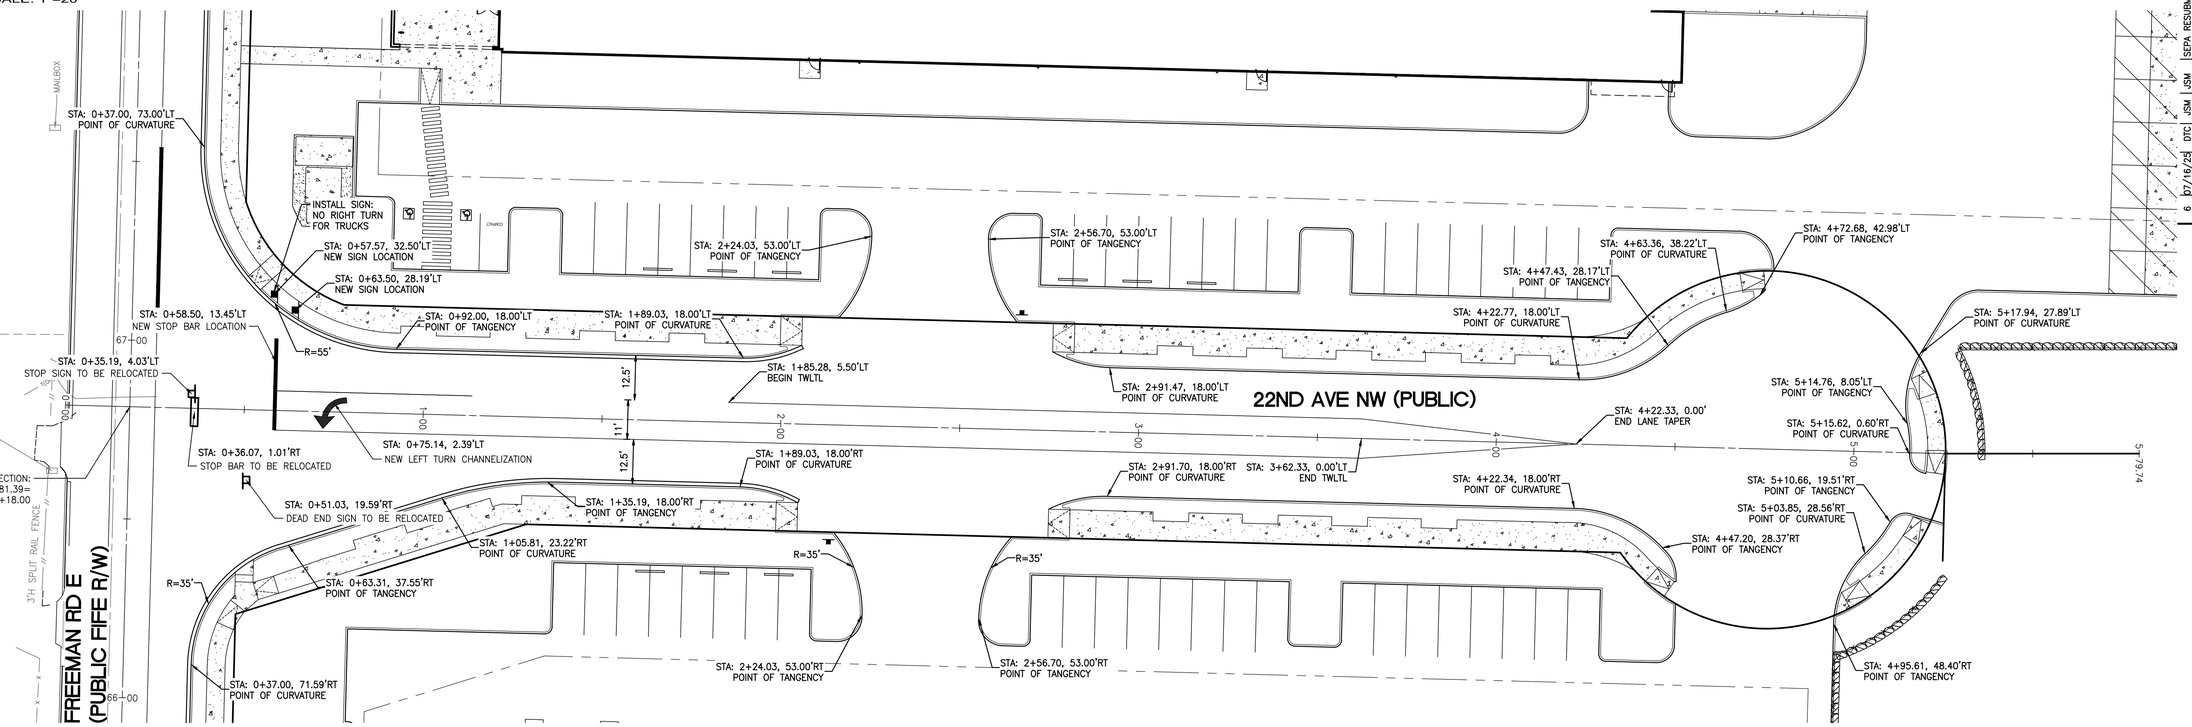

LENGTH	NUMBER OF ARROW SETS	LOCATION OF ARROW SET(S)
0' – 100'	0	
101' – 300'	1	0.5L, 0.5L
301' – 500'	2	75', 75', MIDPOINT
501' – 850'	3	75', 0.5L, 75'
851' – 1200'	4	75', *, 75'
1201' – 1750'	5	* SPACE BALANCE OF SETS EVENLY OVER REMAINDER OF SEGMENT.
OVER 1750'	L=100 / 300	ROUND TO NEAREST WHOLE NUMBER

EXAMPLE:




NOTES: 1. STOP BAR IS TO BE INSTALLED ONLY WHERE A TRAFFIC STUDY DETERMINES THEY ARE WARRANTED.
2. SECTION LENGTHS ARE DETERMINED BY INTERESECTION PLACEMENTS, WHICH ARE VARIABLE.

CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS


TWO-WAY LEFT TURN CHANNELIZATION

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
JSM, DEWEN.SVOBODA	LINDA LIAN	COLLEEN BAKER	XXXX	01.03.07
FILE NAME: P:\PW\COMMON\STD\DCITY\2009\01_ST\R01.03\01.03.07		DATE APPROVED: 03/01/2009	DATE REVISED: XX/XX/XX	SCALE: 1:20

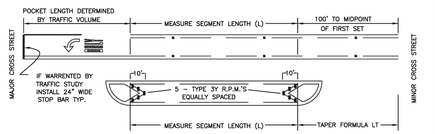

LT=WS (45 MPH OR MORE)
LT=WS²/60 (0 TO 45 MPH)
WHERE: S=POSTED SPEED MPH
LT=LENGTH OF TAPER IN FEET
W=OFFSET IN FEET

SCALE: 1:40



TYPE 2YY RPM PER CITY STANDARD DETAIL NO. 01.03.10 DETAIL "D" AND NOTE #1.

SCALE: 1:20

CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

TWO-WAY LEFT TURN CHANNELIZATION (CONT.)

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
JSM, DEWEN.SVOBODA	LINDA LIAN	COLLEEN BAKER	XXXX	01.03.08
FILE NAME: P:\PW\COMMON\STD\DCITY\2009\01_ST\R01.03\01.03.08		DATE APPROVED: 03/01/2009	DATE REVISED: XX/XX/XX	SCALE: 1:20

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY CHANNELIZATION AND SIGNAGE PLAN 22ND AVE NW FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. BARGHAUSEN — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=20' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C36 of 48

P:\21000s\21585\engineering\SEPA SET\21585-C.dwg 7/16/2025 10:52 AM DCASEY

PRELIMINARY CONSTRUCTION NOTES

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

GENERAL NOTE: CITY OF FIFE UTILITY AND ROW PERMITS NEED TO BE INCULDED IN THESE NOTES.

GENERAL NOTES:

1. ALL WORK IN CITY RIGHT-OF-WAY REQUIRES A PERMIT FROM THE CITY OF PUYALLUP. PRIOR TO ANY WORK COMMENCING, THE GENERAL CONTRACTOR SHALL ARRANGE FOR A PRECONSTRUCTION MEETING AT THE DEVELOPMENT SERVICES CENTER TO BE ATTENDED BY ALL CONTRACTORS THAT WILL PERFORM WORK SHOWN ON THE APPROVED ENGINEERING PLANS, REPRESENTATIVES FROM ALL APPLICABLE UTILITY COMPANIES, THE PROJECT OWNER AND APPROPRIATE CITY STAFF. CONTACT ENGINEERING SERVICES TO SCHEDULE THE MEETING (253) 841-5568. THE CONTRACTOR IS RESPONSIBLE TO HAVE THEIR OWN SET OF APPROVED PLANS AT THE MEETING.

2. AFTER COMPLETION OF ALL ITEMS SHOWN ON THESE PLANS AND BEFORE ACCEPTANCE OF THE PROJECT THE CONTRACTOR SHALL OBTAIN A 'PUNCH LIST' PREPARED BY THE CITY'S INSPECTOR DETAILING REMAINING ITEMS OF WORK TO BE COMPLETED. ALL ITEMS OF WORK SHOWN ON THESE PLANS SHALL BE COMPLETED TO THE SATISFACTION OF THE CITY PRIOR TO ACCEPTANCE OF THE WATER SYSTEM AND PROVISION OF SANITARY SEWER SERVICE.

3. ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION (HEREINAFTER REFERRED TO AS THE 'STANDARD SPECIFICATIONS') WASHINGTON STATE DEPARTMENT OF TRANSPORTATION AND AMERICAN PUBLIC WORKS ASSOCIATION, WASHINGTON STATE CHAPTER, LATEST EDITION, UNLESS SUPERSEDED OR AMENDED BY THE CITY OF PUYALLUP CITY STANDARDS FOR PUBLIC WORKS ENGINEERING AND CONSTRUCTION (HEREINAFTER REFERRED TO AS THE 'CITY STANDARDS').

4. A COPY OF THESE APPROVED PLANS AND APPLICABLE CITY DEVELOPER SPECIFICATIONS AND DETAILS SHALL BE ON SITE DURING CONSTRUCTION.

5. ANY REVISIONS MADE TO THESE PLANS MUST BE REVIEWED AND APPROVED BY THE DEVELOPER'S ENGINEER AND THE CITY PRIOR TO ANY IMPLEMENTATION IN THE FIELD. THE CITY SHALL NOT BE RESPONSIBLE FOR ANY ERRORS AND/OR OMISSIONS ON THESE PLANS.

6. THE CONTRACTOR SHALL HAVE ALL UTILITIES VERIFIED ON THE GROUND PRIOR TO ANY CONSTRUCTION. CALL (811) AT LEAST TWO WORKING DAYS IN ADVANCE. THE OWNER AND HIS/HER ENGINEER SHALL BE CONTACTED IMMEDIATELY IF A CONFLICT EXISTS.

7. ANY STRUCTURE AND/OR OBSTRUCTION THAT REQUIRES REMOVAL OR RELOCATION RELATING TO THIS PROJECT SHALL BE DONE SO AT THE DEVELOPER'S EXPENSE.

8. LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE TRUE ELEVATIONS AND LOCATIONS OF HIDDEN UTILITIES. ALL VISIBLE ITEMS SHALL BE THE ENGINEER'S RESPONSIBILITY.

9. THE CONTRACTOR SHALL INSTALL, REPLACE, OR RELOCATE ALL SIGNS, AS SHOWN ON THE PLANS OR AS AFFECTED BY CONSTRUCTION, PER CITY STANDARDS.

10. POWER, STREET LIGHT, CABLE, AND TELEPHONE LINES SHALL BE IN A TRENCH LOCATED WITHIN A 10-FOOT UTILITY EASEMENT ADJACENT TO PUBLIC RIGHT-OF-WAY. RIGHT-OF-WAY CROSSINGS SHALL HAVE A MINIMUM HORIZONTAL SEPARATION FROM OTHER UTILITIES (SEWER, WATER, AND STORM) OF 5 FEET.

11. ALL CONSTRUCTION SURVEYING FOR EXTENSIONS OF PUBLIC FACILITIES SHALL BE DONE UNDER THE DIRECTION OF A WASHINGTON STATE LICENSED LAND SURVEYOR OR A WASHINGTON STATE LICENSED PROFESSIONAL CIVIL ENGINEER.

12. DURING CONSTRUCTION, ALL PUBLIC STREETS ADJACENT TO THIS PROJECT SHALL BE KEPT CLEAN OF ALL MATERIAL DEPOSITS RESULTING FROM ON-SITE CONSTRUCTION, AND EXISTING STRUCTURES SHALL BE PROTECTED AS DIRECTED BY THE CITY.

13. CERTIFIED RECORD DRAWINGS ARE REQUIRED PRIOR TO PROJECT ACCEPTANCE.

14. A NPDES STORMWATER GENERAL PERMIT MAY BE REQUIRED BY THE DEPARTMENT OF ECOLOGY FOR THIS PROJECT. FOR INFORMATION CONTACT THE DEPARTMENT OF ECOLOGY, SOUTHWEST REGION OFFICE AT (360)407-6300.

15. ANY DISTURBANCE OR DAMAGE TO CRITICAL AREAS AND ASSOCIATED BUFFERS, OR SIGNIFICANT TREES DESIGNATED FOR PRESERVATION AND PROTECTION SHALL BE MITIGATED IN ACCORDANCE WITH A MITIGATION PLAN REVIEWED AND APPROVED BY THE CITY'S PLANNING DIVISION. PREPARATION AND IMPLEMENTATION OF THE MITIGATION PLAN SHALL BE AT THE DEVELOPER'S EXPENSE.

ROADWAY NOTES:

1. ALL WORK IN CITY RIGHT-OF-WAY REQUIRES A PERMIT FROM THE CITY OF PUYALLUP. PRIOR TO ANY WORK COMMENCING, THE GENERAL CONTRACTOR SHALL ARRANGE FOR A PRECONSTRUCTION MEETING AT THE DEVELOPMENT SERVICES CENTER TO BE ATTENDED BY ALL CONTRACTORS THAT WILL PERFORM WORK SHOWN ON THE ENGINEERING PLANS, REPRESENTATIVES FROM ALL APPLICABLE UTILITY COMPANIES, THE PROJECT OWNER AND APPROPRIATE CITY STAFF. CONTACT ENGINEERING SERVICES TO SCHEDULE THE MEETING (253) 841-5568. THE CONTRACTOR IS RESPONSIBLE TO HAVE THEIR OWN APPROVED SET OF PLANS AT THE MEETING.

2. AFTER COMPLETION OF ALL ITEMS SHOWN ON THESE PLANS AND BEFORE ACCEPTANCE OF THE PROJECT, THE CONTRACTOR SHALL OBTAIN A 'PUNCH LIST' PREPARED BY THE CITY'S INSPECTOR DETAILING REMAINING ITEMS OF WORK TO BE COMPLETED. ALL ITEMS OF WORK SHOWN ON THESE PLANS SHALL BE COMPLETED TO THE SATISFACTION OF THE CITY PRIOR TO ACCEPTANCE OF THE WATER SYSTEM AND PROVISION OF SANITARY SEWER SERVICE.

3. ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION (HEREINAFTER REFERRED TO AS THE 'STANDARD SPECIFICATIONS'), WASHINGTON STATE DEPARTMENT OF TRANSPORTATION AND AMERICAN PUBLIC WORKS ASSOCIATION, WASHINGTON STATE CHAPTER, LATEST EDITION, UNLESS SUPERSEDED OR AMENDED BY THE CITY OF PUYALLUP CITY STANDARDS FOR PUBLIC WORKS ENGINEERING AND CONSTRUCTION (HEREINAFTER REFERRED TO AS THE 'CITY STANDARDS').

4. A COPY OF THESE APPROVED PLANS AND APPLICABLE CITY DEVELOPER SPECIFICATIONS AND DETAILS SHALL BE ON SITE DURING CONSTRUCTION.

5. ANY REVISIONS MADE TO THESE PLANS MUST BE REVIEWED AND APPROVED BY THE DEVELOPER'S ENGINEER AND THE ENGINEERING SERVICES STAFF PRIOR TO ANY IMPLEMENTATION IN THE FIELD. THE CITY SHALL NOT BE RESPONSIBLE FOR ANY ERRORS AND/OR OMISSIONS ON THESE PLANS.

6. THE CONTRACTOR SHALL HAVE ALL UTILITIES VERIFIED ON THE GROUND PRIOR TO ANY CONSTRUCTION. CALL (811) AT LEAST TWO WORKING DAYS IN ADVANCE. THE OWNER AND HIS/HER ENGINEER SHALL BE CONTACTED IMMEDIATELY IF A CONFLICT EXISTS.

7. ANY STRUCTURE AND/OR OBSTRUCTION WHICH REQUIRES REMOVAL OR RELOCATION RELATING TO THIS PROJECT, SHALL BE DONE SO AT THE DEVELOPER'S EXPENSE.

8. MONUMENTS SHALL BE INSTALLED AT ALL STREET INTERSECTIONS, AT ANGLE POINTS, AND POINTS OF CURVATURE IN EACH STREET. ALL BOUNDARY MONUMENTS MUST BE INSTALLED ACCORDING TO THE WASHINGTON STATE SUBDIVISION LAWS.

9. CURB AND GUTTER INSTALLATION SHALL CONFORM TO CITY STANDARD DETAIL 01.02.09.

10. SIDEWALKS AND DRIVEWAYS SHALL BE INSTALLED AS LOTS ARE BUILT ON. SIDEWALKS AND DRIVEWAYS SHALL CONFORM TO CITY STANDARD DETAIL 01.02.01, 01.02.02 AND 01.02.12. IF ASPHALT IS DAMAGED DURING REPLACEMENT OF CURB AND GUTTER, THE REPAIR SHALL CONFORM TO CITY STANDARD DETAIL 01.02.10.

11. THE SURROUNDING GROUND (5 FEET BEYOND THE BASE) FOR ALL POWER TRANSFORMERS, TELEPHONE/TV PEDESTALS, AND STREET LIGHT MAIN DISCONNECTS SHALL BE GRADED TO A POSITIVE 2 PERCENT SLOPE FROM TOP OF CURB.

12. SIGNAGE AND TRAFFIC CONTROL DEVICES ARE SAFETY ITEMS AND SHALL BE INSTALLED PRIOR TO ISSUANCE OF ANY CERTIFICATE OF OCCUPANCY OR PLAT APPROVAL. HOWEVER, IN LARGER DEVELOPMENTS, EXACT LOCATIONS OF STOP AND YIELD SIGNS MAY NEED TO BE DETERMINED AFTER FULL BUILDOUT WHEN TRAFFIC PATTERNS HAVE BEEN ESTABLISHED. IN THIS CASE, CONTRACTOR SHALL PROVIDE INDICATED 'CITY-PLACED' SIGNS, SIGNPOSTS, AND BRACKETS TO THE CITY SIGN SPECIALIST (253) 841-5471 FOR LATER INSTALLATION BY THE CITY. ALL SIGNAGE SHALL BE IN ACCORDANCE WITH THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD).

13. PRIOR TO ANY SIGN OR STRIPING INSTALLATION OR REMOVAL THE CONTRACTOR SHALL CONTACT THE CITY SIGN SPECIALIST (253) 841-5471 TO ARRANGE FOR AN ON-SITE MEETING TO DISCUSS PLACEMENT AND UNIFORMITY.

14. NEW OR REVISED STOP SIGNS OR YIELD SIGNS SHALL BE ADVANCE WARNED USING THE PROCEDURE OUTLINED IN THE MUTCD. ADVANCE WARNING SIGNS AND FLAGS SHALL BE MAINTAINED BY INSTALLER FOR 30 DAYS AND THEN REMOVED.

STORMWATER NOTES:

1. ALL WORK IN CITY RIGHT-OF-WAY REQUIRES A PERMIT FROM THE CITY OF PUYALLUP. PRIOR TO ANY WORK COMMENCING, THE GENERAL CONTRACTOR SHALL ARRANGE FOR A PRECONSTRUCTION MEETING AT THE DEVELOPMENT SERVICES CENTER TO BE ATTENDED BY ALL CONTRACTORS THAT WILL PERFORM WORK SHOWN ON THE ENGINEERING PLANS, REPRESENTATIVES FROM ALL APPLICABLE UTILITY COMPANIES, THE PROJECT OWNER AND APPROPRIATE CITY STAFF. CONTACT ENGINEERING SERVICES TO SCHEDULE THE MEETING (253) 841-5568. THE CONTRACTOR IS RESPONSIBLE TO HAVE THEIR OWN APPROVED SET OF PLANS AT THE MEETING.

2. AFTER COMPLETION OF ALL ITEMS SHOWN ON THESE PLANS AND BEFORE ACCEPTANCE OF THE PROJECT, THE CONTRACTOR SHALL OBTAIN A 'PUNCH LIST' PREPARED BY THE CITY'S INSPECTOR DETAILING REMAINING ITEMS OF WORK TO BE COMPLETED. ALL ITEMS OF WORK SHOWN ON THESE PLANS SHALL BE COMPLETED TO THE SATISFACTION OF THE CITY PRIOR TO ACCEPTANCE OF THE WATER SYSTEM AND PROVISION OF SANITARY SEWER SERVICE.

3. ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION (HEREINAFTER REFERRED TO AS THE 'STANDARD SPECIFICATIONS'), WASHINGTON STATE DEPARTMENT OF TRANSPORTATION AND AMERICAN PUBLIC WORKS ASSOCIATION, WASHINGTON STATE CHAPTER, LATEST EDITION, UNLESS SUPERSEDED OR AMENDED BY THE CITY OF PUYALLUP CITY STANDARDS FOR PUBLIC WORKS ENGINEERING AND CONSTRUCTION (HEREINAFTER REFERRED TO AS THE 'CITY STANDARDS').

4. A COPY OF THESE APPROVED PLANS AND APPLICABLE CITY DEVELOPER SPECIFICATIONS AND DETAILS SHALL BE ON SITE DURING CONSTRUCTION.

5. ANY REVISIONS MADE TO THESE PLANS MUST BE REVIEWED AND APPROVED BY THE DEVELOPER'S ENGINEER AND THE ENGINEERING SERVICES STAFF PRIOR TO ANY IMPLEMENTATION IN THE FIELD. THE CITY SHALL NOT BE RESPONSIBLE FOR ANY ERRORS AND/OR OMISSIONS ON THESE PLANS.

6. THE CONTRACTOR SHALL HAVE ALL UTILITIES VERIFIED ON THE GROUND PRIOR TO ANY CONSTRUCTION. CALL (811) AT LEAST TWO WORKING DAYS IN ADVANCE. THE OWNER AND HIS/HER ENGINEER SHALL BE CONTACTED IMMEDIATELY IF A CONFLICT EXISTS.

7. ANY STRUCTURE AND/OR OBSTRUCTION WHICH REQUIRES REMOVAL OR RELOCATION RELATING TO THIS PROJECT SHALL BE DONE SO AT THE DEVELOPER'S EXPENSE.

8. DURING CONSTRUCTION, ALL EXISTING AND NEWLY INSTALLED DRAINAGE STRUCTURES SHALL BE PROTECTED FROM SEDIMENTS.

9. ALL STORM MANHOLES SHALL CONFORM TO CITY STANDARD DETAIL NO. 02.01.01. FLOW CONTROL MANHOLE/OIL WATER SEPARATOR SHALL CONFORM TO CITY STANDARD DETAIL NO. 02.01.06 AND 02.01.07.

10. MANHOLE RING AND COVER SHALL CONFORM TO CITY STANDARD DETAIL 06.01.02 AND 06.01.03. THE COVER SHALL BE MARKED WITH 'STORM' OR 'DRAIN' IN 2-INCH RAISED LETTERS. MINIMUM WEIGHT OF THE FRAME SHALL BE 210 POUNDS. MINIMUM WEIGHT OF THE COVER SHALL BE 150 POUNDS.

11. CATCH BASINS TYPE I SHALL CONFORM TO CITY STANDARD DETAIL NO.02.01.02 AND 02.01.03 AND SHALL BE USED ONLY FOR DEPTHS LESS THAN 5 FEET FROM TOP OF THE GRATE TO THE INVERT OF THE STORM PIPE.

12. CATCH BASINS TYPE II SHALL CONFORM TO CITY STANDARD DETAIL NO.02.01.04 AND SHALL BE USED FOR DEPTHS GREATER THAN 5 FEET FROM TOP OF THE GRATE TO THE INVERT OF THE STORM PIPE.

13. CAST IRON OR DUCTILE IRON FRAME AND GRATE SHALL CONFORM TO CITY STANDARD DETAIL NO.02.01.05. GRATE SHALL BE MARKED WITH 'DRAINS TO STREAM'. SOLID CATCH BASIN LIDS (SQUARE UNLESS NOTED AS ROUND) SHALL CONFORM TO WSDOT STANDARD PLAN B-2 (OLYMPIC FOUNDRY NO. SM60 OR EQUAL). VANED GRATES SHALL CONFORM TO WSDOT STANDARD PLAN B-2A (OLYMPIC FOUNDRY NO. SM60V OR EQUAL).

14. STORMWATER PIPE SHALL BE ONLY PVC, CONCRETE OR DUCTILE IRON PIPE.
    A. THE USE OF ANY OTHER TYPE SHALL BE REVIEWED AND APPROVED BY THE ENGINEERING SERVICES STAFF PRIOR TO INSTALLATION.
    B. PVC PIPE SHALL BE PER ASTM D3034, SDR 35 FOR PIPE SIZE 15-INCH AND SMALLER AND F679 FOR PIPE SIZES 18 TO 27 INCH. MINIMUM COVER ON PVC PIPE SHALL BE 3.0 FEET.
    C. CONCRETE PIPE SHALL CONFORM TO THE WSDOT STANDARD SPECIFICATIONS FOR CONCRETE UNDERDRAIN PIPE. MINIMUM COVER ON CONCRETE PIPE SHALL NOT LESS THAN 3.0 FEET.
    D. DUCTILE IRON PIPE SHALL BE CLASS 50, CONFORMING TO AWWA C151. MINIMUM COVER ON DUCTILE IRON PIPE SHALL BE 1.0 FOOT.
    E. POLYPROPYLENE PIPE (PP) SHALL BE DUAL WALLED, HAVE A SMOOTH INTERIOR AND EXTERIOR CORRUGATIONS AND MEET WSDOT 9-05.24(1). 12-INCH THROUGH 30"-INCH PIPE SHALL MEET OR EXCEED ASTM F2736 AND AASHTO M330, TYPE S, OR TYPE D. 36-INCH THROUGH 60-INCH PIPE SHALL MEET OR EXCEED ASTM F2881 AND AASHTO M330, TYPE S, OR TYPE D. TESTING SHALL BE PER ASTM F1417. MINIMUM COVER OVER POLYPROPYLENE PIPE SHALL BE 3-FEET.

15. TRENCHING, BEDDING, AND BACKFILL FOR PIPE SHALL CONFORM TO CITY STANDARD DETAIL NO. 06.01.01.

16. STORM PIPE SHALL BE A MINIMUM OF 10 FEET AWAY FROM BUILDING FOUNDATIONS AND/OR ROOF LINES.

17. ALL STORM DRAIN MAINS SHALL BE VIDEO INSPECTED BY THE CITY OF PUYALLUP COLLECTIONS DIVISION PRIOR TO FINAL ACCEPTANCE BY THE CITY.

18. AFTER ALL OTHER UTILITIES ARE INSTALLED AND PRIOR TO ASPHALT WORK, ALL STORM PIPE SHALL PASS A LOW PRESSURE AIR TEST IN ACCORDANCE WITH SECTION 7-04.3(4)D OF THE STANDARD SPECIFICATIONS. PRODUCTS USED TO SEAL THE INSIDE OF THE PIPE ARE NOT TO BE USED TO OBTAIN THE AIR TEST.

19. ALL STORM DRAIN MAINS SHALL BE MANDRELLED.

20. ALL TEMPORARY SEDIMENTATION AND EROSION CONTROL MEASURES, AND PROTECTIVE MEASURES FOR CRITICAL AREAS AND SIGNIFICANT TREES SHALL BE INSTALLED PRIOR TO INITIATING ANY CONSTRUCTION ACTIVITIES.

WATER SYSTEM NOTES:

1. ALL WORK IN CITY RIGHT-OF-WAY REQUIRES A PERMIT FROM THE CITY OF PUYALLUP. PRIOR TO ANY WORK COMMENCING, THE GENERAL CONTRACTOR SHALL ARRANGE FOR A PRECONSTRUCTION MEETING AT THE DEVELOPMENT SERVICES CENTER TO BE ATTENDED BY ALL CONTRACTORS THAT WILL PERFORM WORK SHOWN ON THE ENGINEERING PLANS, REPRESENTATIVES FROM ALL APPLICABLE UTILITY COMPANIES, THE PROJECT OWNER AND APPROPRIATE CITY STAFF. CONTACT ENGINEERING SERVICES TO SCHEDULE THE MEETING (253) 841-5568. THE CONTRACTOR IS RESPONSIBLE TO HAVE THEIR OWN APPROVED SET OF PLANS AT THE MEETING.

2. AFTER COMPLETION OF ALL ITEMS SHOWN ON THESE PLANS AND BEFORE ACCEPTANCE OF THE PROJECT, THE CONTRACTOR SHALL OBTAIN A 'PUNCH LIST' PREPARED BY THE CITY'S INSPECTOR DETAILING REMAINING ITEMS OF WORK TO BE COMPLETED. ALL ITEMS OF WORK SHOWN ON THESE PLANS SHALL BE COMPLETED TO THE SATISFACTION OF THE CITY PRIOR TO ACCEPTANCE OF THE WATER SYSTEM AND PROVISION OF SANITARY SEWER SERVICE.

3. ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION (HEREINAFTER REFERRED TO AS THE 'STANDARD SPECIFICATIONS'), WASHINGTON STATE DEPARTMENT OF TRANSPORTATION AND AMERICAN PUBLIC WORKS ASSOCIATION, WASHINGTON STATE CHAPTER, LATEST EDITION, UNLESS SUPERSEDED OR AMENDED BY THE CITY OF PUYALLUP CITY STANDARDS FOR PUBLIC WORKS ENGINEERING AND CONSTRUCTION (HEREINAFTER REFERRED TO AS THE 'CITY STANDARDS'), VALLEY WATER (VW), OR TACOMA CITY WATER (TCW) IS THE PURVEYOR.

4. A COPY OF THESE APPROVED PLANS AND APPLICABLE CITY DEVELOPER SPECIFICATIONS AND DETAILS SHALL BE ON SITE DURING CONSTRUCTION.

5. ANY REVISIONS MADE TO THESE PLANS MUST BE REVIEWED AND APPROVED BY THE DEVELOPER'S ENGINEER AND THE ENGINEERING SERVICES STAFF, AND THE FMWC, VW OR TCW WHEN SERVED BY THAT PURVEYOR, PRIOR TO ANY IMPLEMENTATION IN THE FIELD. THE CITY SHALL NOT BE RESPONSIBLE FOR ANY ERRORS AND/OR OMISSIONS ON THESE PLANS.

6. THE CONTRACTOR SHALL HAVE ALL UTILITIES VERIFIED ON THE GROUND PRIOR TO ANY CONSTRUCTION. CALL (811) AT LEAST TWO WORKING DAYS IN ADVANCE. THE OWNER AND HIS/HER ENGINEER SHALL BE CONTACTED IMMEDIATELY IF A CONFLICT EXISTS.

7. ANY STRUCTURE AND/OR OBSTRUCTION WHICH REQUIRES REMOVAL OR RELOCATION RELATING TO THIS PROJECT SHALL BE DONE SO AT THE DEVELOPER'S EXPENSE.

8. BACTERIOLOGICAL (COLIFORM AND IRON BACTERIA) TEST SAMPLES WILL BE TAKEN BY THE CITY (OR FMWC, VW OR TCW WHEN SERVED BY THAT PURVEYOR) AND PAID FOR BY THE CONTRACTOR.

WATER SYSTEM NOTES (CONT.):

9. WATER MAINS SHALL HAVE A MINIMUM COVER OF 36 INCHES FROM PAVED FINAL GRADE IN IMPROVED RIGHT-OF-WAY AND IMPROVED EASEMENTS, AND A MINIMUM OF 48 INCHES IN UNIMPROVED RIGHT-OFWAY AND UNIMPROVED EASEMENTS.

10. PIPE FOR WATER MAINS SHALL BE DUCTILE IRON CONFORMING TO SECTION 7-09 OF THE STANDARD SPECIFICATIONS, CLASS 52 WITH TYTON OR APPROVED EQUAL JOINTS. PIPE SHALL BE CEMENT LINED IN ACCORDANCE WITH A.S.A. SPECIFICATION A 21.4-1964.

11. CONNECTIONS TO EXISTING WATER MAINS TYPICALLY SHALL BE WET TAPS THROUGH A TAPPING TEE AND TAPPING VALVE AND SHALL BE MADE BY A CITY APPROVED CONTRACTOR. THE TAPPING SLEEVE SHALL BE ROMAC SST ALL STAINLESS STEEL TAPPING SLEEVE OR APPROVED EQUAL. A TWO-PIECE EPOXY COATED OR DUCTILE IRON TAPPING SLEEVE MAY BE USED ON DUCTILE IRON PIPE, WHEN THE TAP IS SMALLER THAN THE WATER MAIN SIZE I.E. 6 INCH TAP ON 8 INCH PIPE. THE CITY (OR FMWC, VW OR TCW WHEN SERVED BY THAT PURVEYOR) SHALL APPROVE THE TIME AND LOCATION FOR THESE CONNECTIONS.

12. ALL WATER MAINS AND APPURTENANCES SHALL BE HYDROSTATICALLY TESTED AT 200 PSI IN ACCORDANCE WITH CITY STANDARDS. PRESSURE TESTING SHALL NOT BE PERFORMED UNTIL SATISFACTORY PURITY SAMPLES HAVE BEEN RECEIVED, EXCEPT WHEN NEW WATER MAINS ARE INSTALLED INDEPENDENTLY FROM THE WATER SYSTEM PIPING.

13. FIRE HYDRANTS SHALL BE INSTALLED IN ACCORDANCE WITH CITY STANDARD DETAIL 03.05.01 AND AS DIRECTED BY THE CITY OF PUYALLUP FIRE CODE OFFICIAL.

14. VALVE MARKER POSTS SHALL BE INSTALLED WHERE VALVE BOXES ARE HIDDEN FROM VIEW OR IN UNPAVED AREAS THE INSTALLATION SHALL BE IN ACCORDANCE WITH CITY STANDARD DETAIL 03.01.02.

15. RESILIENT SEATED WEDGE GATE VALVES SHALL BE USED FOR 10-INCH MAINS AND SMALLER. BUTTERFLY VALVES SHALL BE USED FOR MAINS GREATER THAN 10 INCHES.

16. PIPE FITTING FOR WATER MAINS SHALL BE DUCTILE IRON AND SHALL BE MECHANICAL JOINT CONFORMING TO AWWA SPECIFICATION C111-72.

17. WATER MAIN PIPE AND SERVICE CONNECTIONS SHALL BE A MINIMUM OF 10 FEET AWAY FROM BUILDING FOUNDATIONS AND/OR ROOF LINES.

18. WHERE A WATER MAIN CROSSES THE NORTHWEST GAS PIPELINE, THE WATER LINE SHALL BE CASED WITH PVC PIPE A MINIMUM OF 10 FEET BEYOND EACH SIDE OF THE GAS LINE EASEMENT. CONTACT WILLIAMS NORTHWEST PIPELINE BEFORE THE CROSSING IS MADE.

19. TRENCHING, BEDDING, AND BACKFILL FOR WATER MAINS SHALL BE INSTALLED IN ACCORDANCE WITH CITY STANDARD DETAIL 06.01.01.

20. ALL COMMERCIAL AND INDUSTRIAL DEVELOPMENTS, IRRIGATION SYSTEMS, AND MULTI-FAMILY WATER SERVICE CONNECTIONS SHALL BE PROTECTED BY A DOUBLE CHECK VALVE ASSEMBLY OR A REDUCED PRESSURE BACKFLOW ASSEMBLY AS DIRECTED BY THE CITY (OR FMWC, VW OR TCW WHEN SERVED BY THAT PURVEYOR) CONFORMING TO CITY STANDARD DETAILS 03.04.01 AND 03.04.02-1, 03.04.02-2 AND 03.04.03.

21. ANY LEAD JOINT FITTING DISTURBED DURING CONSTRUCTION SHALL BE REPLACED WITH A MECHANICAL JOINT FITTING AT THE CONTRACTOR'S EXPENSE.

22. WHEN HYDRAULIC FIRE FLOW MODELING IS REQUIRED FOR A PROJECT, THE CITY WILL ISSUE A PERMIT. THE HYDRAULIC MODELING CRITERIA IS BASED ON THE PROJECTED 2030 WATER DEMAND, WHILE MAINTAINING A MINIMUM SYSTEM PRESSURE OF 20 POUNDS PER SQUARE INCH AND A MAXIMUM VELOCITY OF 10 FEET PER SECOND.

23. WHEN FILLING A NEW WATER MAIN FOR PURITY WITH HIGHLY CONCENTRATED CHLORINE WATER, THAT "SUPER" CHLORINATED WATER CANNOT SIT INSIDE THE NEW WATER MAIN FOR GREATER THAN 5 DAYS.

24. WHEN USING A FIRE HYDRANT FOR NON-FIREFIGHTING PURPOSES, A CITY HYDRANT METER MUST BE USED. COORDINATE THE ACQUISITION OF THE HYDRANT METER WITH THE CITY'S UTILITY BILLING DIVISION AT PUYALLUP CITY HALL. A CITY APPROVED BACKFLOW PROTECTION ASSEMBLY SHALL BE INSTALLED BY THE PERSON REQUESTING USE OF A FIRE HYDRANT. THE ASSEMBLY SHALL BE ACCOMPANIED BY A CURRENT BACKFLOW ASSEMBLY TEST REPORT. THE TEST REPORT SHALL BE AVAILABLE AT THE SITE FOR THE DURATION OF THE HYDRANT USE.

SANITARY SEWER NOTES:

1. ALL WORK IN CITY RIGHT-OF-WAY REQUIRES A PERMIT FROM THE CITY OF PUYALLUP. PRIOR TO ANY WORK COMMENCING, THE GENERAL CONTRACTOR SHALL ARRANGE FOR A PRECONSTRUCTION MEETING AT THE DEVELOPMENT SERVICES CENTER TO BE ATTENDED BY ALL CONTRACTORS THAT WILL PERFORM WORK SHOWN ON THE ENGINEERING PLANS, REPRESENTATIVES FROM ALL APPLICABLE UTILITY COMPANIES, THE PROJECT OWNER AND APPROPRIATE CITY STAFF. CONTACT ENGINEERING SERVICES TO SCHEDULE THE MEETING (253) 841-5568. THE CONTRACTOR IS RESPONSIBLE TO HAVE THEIR OWN APPROVED SET OF PLANS AT THE MEETING.

2. AFTER COMPLETION OF ALL ITEMS SHOWN ON THESE PLANS AND BEFORE ACCEPTANCE OF THE PROJECT, THE CONTRACTOR SHALL OBTAIN A 'PUNCH LIST' PREPARED BY THE CITY'S INSPECTOR DETAILING REMAINING ITEMS OF WORK TO BE COMPLETED. ALL ITEMS OF WORK SHOWN ON THESE PLANS SHALL BE COMPLETED TO THE SATISFACTION OF THE CITY PRIOR TO ACCEPTANCE OF THE WATER SYSTEM AND PROVISION OF SANITARY SEWER SERVICE.

3. ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION (HEREINAFTER REFERRED TO AS THE 'STANDARD SPECIFICATIONS'), WASHINGTON STATE DEPARTMENT OF TRANSPORTATION AND AMERICAN PUBLIC WORKS ASSOCIATION, WASHINGTON STATE CHAPTER, LATEST EDITION, UNLESS SUPERSEDED OR AMENDED BY THE CITY OF PUYALLUP CITY STANDARDS FOR PUBLIC WORKS ENGINEERING AND CONSTRUCTION (HEREINAFTER REFERRED TO AS THE 'CITY STANDARDS').

4. A COPY OF THESE APPROVED PLANS AND APPLICABLE CITY DEVELOPER SPECIFICATIONS AND DETAILS SHALL BE ON SITE DURING CONSTRUCTION.

5. ANY REVISIONS MADE TO THESE PLANS MUST BE REVIEWED AND APPROVED BY THE DEVELOPER'S ENGINEER AND THE ENGINEERING SERVICES STAFF PRIOR TO ANY IMPLEMENTATION IN THE FIELD. THE CITY SHALL NOT BE RESPONSIBLE FOR ANY ERRORS AND/OR OMISSIONS ON THESE PLANS.

6. THE CONTRACTOR SHALL HAVE ALL UTILITIES VERIFIED ON THE GROUND PRIOR TO ANY CONSTRUCTION. CALL 811 AT LEAST TWO WORKING DAYS IN ADVANCE. THE OWNER AND HIS/HER ENGINEER SHALL BE CONTACTED IMMEDIATELY IF A CONFLICT EXISTS.

7. ANY STRUCTURE AND/OR OBSTRUCTION WHICH REQUIRE REMOVAL OR RELOCATION RELATING TO THIS PROJECT SHALL BE DONE SO AT THE DEVELOPER'S EXPENSE.

8. MINIMUM GRADE ON ALL 4 INCH RESIDENTIAL SIDE SEWERS SHALL BE 2 PERCENT AND 6 INCH COMMERCIAL SIDE SEWERS SHALL BE 1 PERCENT; MAXIMUM SHALL BE 8 PERCENT. ALL SIDE SEWERS SHALL BE 6 INCHES WITHIN CITY RIGHT-OF-WAY.

9. SIDE SEWERS SHALL BE INSTALLED IN ACCORDANCE WITH CITY STANDARD NOS. 04.03.01, 04.03.02, 04.03.03 AND 04.03.04. SIDE SEWER INSTALLATION WORK SHALL BE DONE IN ACCORDANCE WITH THE WASHINGTON INDUSTRIAL SAFETY AND HEALTH ACT (WISHA).

10. ALL SEWER PIPE SHALL BE PVC, POLYPROPYLENE, OR DUCTILE IRON. PVC SEWER PIPE SHALL CONFORM TO ASTM D-3034, SDR35 FOR PIPE SIZES 15-INCH AND SMALLER AND ASTM F679 FOR PIPE SIZES 18- TO 27-INCH, DUCTILE IRON PIPE SHALL BE CLASS 51 OR GREATER UNLESS OTHERWISE NOTED., 12-INCH THROUGH 30"-INCH POLYPROPYLENE PIPE (PP) SHALL BE DUAL WALLED, HAVE A SMOOTH INTERIOR AND EXTERIOR CORRUGATIONS AND MEET WSDOT 9-05.24(2). IT SHALL MEET OR EXCEED ASTM F2736. 36-INCH THROUGH 60-INCH PP PIPE SHALL BE TRIPLE WALLED AND MEET WSDOT 9-05.24(2). IT SHALL MEET OR EXCEED ASTM F2764. PP SHALL HAVE A MINIMUM PIPE STIFFNESS OF 46 PSI WHEN TESTED IN ACCORDANCE WITH ASTM D2412. TESTING SHALL BE PER ASTM F1417. TRENCHING, BEDDING, AND BACKFILL SHALL BE IN ACCORDANCE WITH CITY STANDARD NO. 06.01.01. MINIMUM COVER ON PVC AND PP PIPE SHALL BE 3.0 FEET. MINIMUM COVER ON DUCTILE IRON PIPE SHALL BE 1.0 FOOT.

11. SANITARY SEWER MANHOLE FRAMES AND COVERS SHALL CONFORM TO CITY STANDARD NOS. 06.01.02 AND 6.1.3COVERS SHALL BE MARKED "SEWER," WITH 2-INCH RAISED LETTERS. MINIMUM WEIGHT OF THE FRAME SHALL BE 210 POUNDS. MINIMUM WEIGHT OF THE COVER SHALL BE 150 POUNDS.

12. SANITARY SEWER MANHOLES SHALL CONFORM TO CITY STANDARD NOS. 04.01.01, 04.01.02, 04.01.03 AND 04.01.04. ALL MANHOLES SHALL BE CHANNELED FOR FUTURE LINES AS SPECIFIED ON THESE PLANS. MANHOLE STEPS AND LADDER SHALL CONFORM TO STANDARD NO. 06.01.04.

13. SANITARY SEWER PIPE AND SIDE SEWERS SHALL BE 10 FEET AWAY FROM BUILDING FOUNDATIONS AND/OR ROOF LINES.

SANITARY SEWER NOTES (CONT.):


14. N

PRELIMINARY CONSTRUCTION DETAILS

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

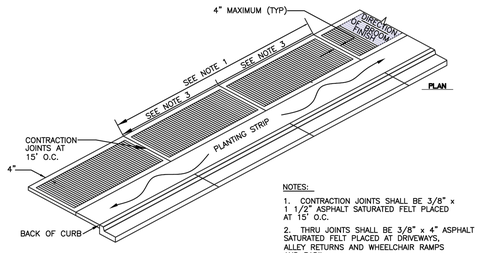


NOTES:

1. CONTRACTION JOINTS SHALL BE 3/8" x 1 1/2" ASPHALT SATURATED FELT PLACED AT 15' O.C.
2. THRU JOINTS SHALL BE 3/8" x 4" ASPHALT SATURATED FELT PLACED AT DRIVEWAYS, ALLEY RETURNS AND WHEELCHAIR RAMPS AND RADII.
3. V-GROOVEMARKS SHALL BE 1/8" DEEP AND 1/4" WIDE PLACED AT 5' O.C. FOR 5' SIDEWALKS AND 7.5' O.C. FOR 8' SIDEWALKS.
4. ALL JOINTS SHALL BE CLEAN AND EDGED TO A 1/4" RADIUS. JOINTS SHALL BE FLUSH WITH THE FINISHED SURFACE.
5. ALL UTILITY POLES AND STREET SIGN POSTS IN SIDEWALK AREA NOT REQUIRED TO BE RELOCATED SHALL HAVE A SQUARE SECTION OF CONCRETE SURROUNDED BY 3/8" EXPANSION JOINT MATERIAL AROUND THE POLE. THE JOINT SHALL BE NO CLOSER THAN 6" TO ANY SIDE OF THE POLE SIDE OF THE POLE.
6. FORMS SHALL BE EITHER WOOD OR STEEL AND SHALL MEET ALL REQUIREMENTS OF THESE SPECIFICATIONS.
7. CONCRETE SHALL BE CLASS 3000 COMMERCIAL CONCRETE, 5.5 SACK MINIMUM, AASHTO GRADING 467 COARSE AGGREGATE, NO FLY ASH.
8. SIDEWALK MINIMUM UNOBSTRUCTED CLEAR WIDTH SHALL BE 4', EXCLUSIVE OF THE WIDTH OF THE CURB.
9. GRATINGS, ACCESS COVERS, JUNCTION BOXES, CABLE VAULTS, PULL BOXES AND OTHER APPURTENANCES WITHIN THE SIDEWALK (RIGHT OF WAY) MUST HAVE SLIP RESISTANT SURFACES AND MATCH THE GRADE OF THE SIDEWALK.
10. CURB RAMPS SHALL BE CONSTRUCTED AT INTERSECTIONS USING A DESIGN PREPARED BY A LICENSED PROFESSIONAL ENGINEER. WHEN A RAMP DESIGN FAILS TO MEET ALL APPLICABLE DESIGN STANDARDS, THE ENGINEER SHALL DOCUMENT WHY THE PROPOSED RAMP ACHIEVES DESIGN STANDARDS TO THE MAXIMUM EXTENT FEASIBLE.

MINIMUM SIDEWALK WIDTHS


5'(RS ZONES) SINGLE FAMILY RESIDENTIAL AREAS (DETACHED DWELLINGS)
8'(RS ZONES) COMMERCIAL USES, WHEN REQUIRED BY DEVELOPMENT SERVICES MANAGER
8'(RM ZONES) MEDIUM AND HIGH DENSITY MULTI-FAMILY RESIDENTIAL AREAS
8'(ML ZONES) INDUSTRIAL AREAS
8'(CG, CBD ZONES) COMMERCIAL AREAS
8'(PF ZONES) PUBLIC FACILITIES AREAS
8'(F ZONES) FAIR AREAS
* MATCH GREATEST WIDTH FOR ANY ADJACENT ZONE



CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

SIDEWALK WITH PLANTING STRIP

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
JIM ERWIN-SVOBODA	LINDA LIAN	COLLEEN HARRIS	LINDA LIAN	01.02.02
FILE NAME: F:\DWG\COMMON\STDS\CITY\2009\01_STD\01.02\01.02.02	DATE APPROVED: 07/01/2009	DATE REVISED: 08/31/11	SCALE: 1:8	

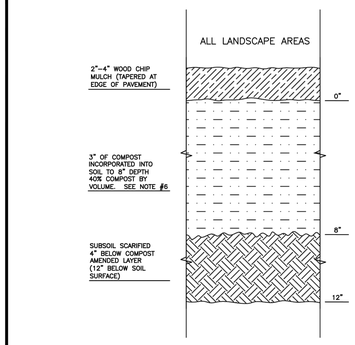


NOTES:

1. ALL SOIL AREAS DISTURBED OR COMPACTED DURING CONSTRUCTION, AND NOT COVERED BY BUILDINGS OR PAVEMENT, SHALL BE AMENDED WITH COMPOST AS DESCRIBED BELOW.
2. SUBSOIL SHOULD BE SCARIFIED (LOOSENED) 4 INCHES BELOW AMENDED LAYER, TO PRODUCE 12-INCH DEPTH OF UN-COMPACTED SOIL, EXCEPT WHERE SCARIFICATION WOULD DAMAGE TREE ROOTS OR AS DETERMINED BY THE ENGINEER. SEE NOTE BELOW REGARDING PLANTING STEPS FOR STREET TREES.
3. COMPOST SHALL BE TILLED IN TO 8 INCH DEPTH INTO EXISTING SOIL, OR PLACE 8 INCHES OF COMPOST-AMENDED SOIL, PER SOIL SPECIFICATION.
4. PLANTING BEDS SHALL RECEIVE 3 INCHES OF COMPOST TILLED IN TO 8-INCH DEPTH, OR MAY SUBSTITUTE 8" OF IMPORTED SOIL CONTAINING 35-40% COMPOST BY VOLUME. MULCH AFTER PLANTING, WITH 4 INCHES OF ARBORIST WOOD CHIP MULCH OR APPROVED EQUAL (6" OF LOOSE WOOD CHIPS AT THE TIME OF PLANTING TO ALLOW SETTLING TO 4").
5. SETBACKS: TO PREVENT UNEVEN SETTLING, DO NOT COMPOST-AMEND SOILS WITHIN 3 FEET OF UTILITY INFRASTRUCTURES (POLES, VAULTS, METERS ETC.), WITHIN ONE FOOT OF PAVEMENT EDGE, CURBS AND SIDEWALKS SOIL SHOULD BE COMPACTED TO APPROXIMATELY 95% PROCTOR TO ENSURE A FIRM SURFACE.
6. SEE SECTION 8.2(8) OF THE WMS FOR SOIL AMENDMENT AND INSTRUCTION PROCEDURES FOR STREET TREE PLANTER STRIPS. ALL STREET TREE PLANTER STRIPS SHALL RECEIVE 40% COMPOST AMENDED SOIL TO THE FULL DEPTH OF THE STREET TREE ROOTBALL.

CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

SOIL AMENDMENT AND DEPTH

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
LINDA LIAN	CHRIS BEALE	COLLEEN HARRIS	XXXX	01.02.08a
FILE NAME: F:\DWG\COMMON\STDS\CITY\STD\STR\01.02.08	DATE APPROVED: 08/01/2015	DATE REVISED: XX/XX/XX	SCALE: 1:1	

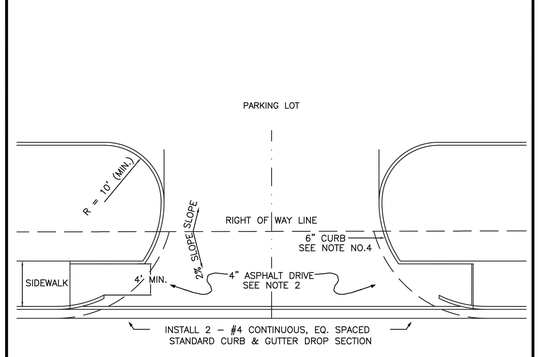


NOTES:

1. TYPICAL COMMERCIAL APPROACHES SHALL BE 30' WIDE AND INCLUDE 35' CURB RADII. IF TRUCKS ARE EXPECTED TO USE THE APPROACH, DRIVEWAY WIDTH, CHANNELIZATION, AND CURB RADII SHALL BE BASED ON AN APPROVED TURNING MOVEMENT ANALYSIS
2. ALL ASPHALT PAVEMENT MUST CONFORM TO CITY STANDARD NO. 01.01.01.
3. APPROACH SHALL BE ASPHALT WITH STANDARD CURB AND GUTTER PLACED ON EACH SIDE OF THE APPROACH.
4. WHEEL CHAIR RAMPS SHALL BE INSTALLED IN ACCORDANCE TO ALL APPLICABLE STANDARDS. DETECTABLE WARNING PATTERNS SHALLBE CONSTRUCTED AT A DRIVEWAY ONLY WHEN IT WILL BE SIGNALIZED. CURB RAMP SLOPE SHALL NOT EXCEED 8.3%, AS MEASURE BY A SMART LEVEL, UNLESS RAMP LENGTH IS EXTENDED TO 15'. SEE DETAIL 01.02.19 FOR ADDITIONAL ADA RAMP INFORMATION.
5. SPACING OF COMMERCIAL APPROACHES ON PRINCIPAL AND MINOR ARTERIALS SHALL BE MINIMUM 300' AND SPACING ON COLLECTORS SHALL BE MINIMUM 150', MEASURED BETWEEN THE CLOSEST EDGES OF EACH DRIVEWAY. THIS REQUIREMENT IS ALSO APPLICABLE TO THE DRIVEWAYS THAT ARE ACROSS THE STREET.
6. SPACING OF COMMERCIAL APPROACHES FROM PRINCIPAL AND MINOR ARTERIALS SHALL BE MINIMUM 300' AND SPACING FROM A COLLECTOR SHALL BE MINIMUM 150', MEASURED FROM NEAREST ROW LINE TO APPROACH PAVEMENT EDGE. THE CITY MAY BE MORE RESTRICTIVE THAN SPECIFIED HEREIN IF DEEMED NECESSARY BASED ON TRAFFIC VOLUMES, CHANNELIZATION AND SIGNALIZATION.
7. THIS COMMERCIAL APPROACH STANDARD SHALL BE USED ON ARTERIALS AND COLLECTORS WITH SPEED LIMITS OF 35 MPH OR GREATER, AND/OR WHEN TRUCK TRAFFIC WILL BE USING THE APPROACH.

CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

STANDARD COMMERCIAL APPROACH

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
JIM ERWIN-SVOBODA	LINDA LIAN	COLLEEN HARRIS	LINDA LIAN	01.02.16
FILE NAME: F:\DWG\COMMON\STDS\CITY\2009\01_STR\01.02\01.02.16	DATE APPROVED: 07/01/2009	DATE REVISED: 12/19/14	SCALE: 1" = 20'	

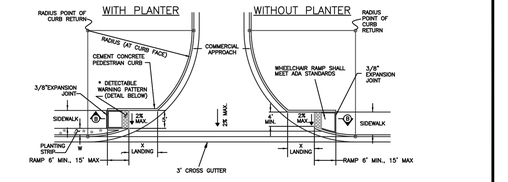

GEOMETRICS TABLE

RADIUS (AT CURB FACE)	W = 3'-0"	W = 4'-0"	W = 5'-0"	W = 6'-0"
	X	X	X	X
25 FEET	6'-3 1/8"	5'-7 1/4"	4'-11 1/8"	4'-4 3/4"
30 FEET	7'-3 3/4"	6'-6 1/2"	5'-9 1/4"	5'-2 1/2"
35 FEET	8'-1 1/2"	7'-1 3/4"	6'-5 1/8"	5'-10 1/8"
40 FEET	8'-9 1/2"	7'-10"	7'-1"	6'-5 3/4"
50 FEET	10'-3/4"	9'-1/4"	8'-2 1/2"	7'-6 1/2"


X = LANDING

CURB GRADE	PROWAG UP-HILL RAMP LENGTH	PROWAG RAMP SLOPE
0.5%	6'-0"	8.3%
1.5%	7'-6"	8.3%
3%	9'-0"	8.3%
5%	15'	8.3%
7%	15'	10.3%
9%	15'	12.3%

NOTES:


1. AVOID PLACING DRAINAGE STRUCTURES OR OTHER OBSTRUCTIONS IN RAMP AND CROSSING AREA.
2. DETECTABLE WARNING PATTERNS MAY BE CREATED BY ANY METHOD THAT WILL ACHIEVE THE TRUNCATED DOME DIMENSIONS AND SPACING SHOWN. THE DETECTABLE WARNING PATTERN AREA SHALL BE YELLOW, AND MATCH THE COLOR OF "FEDERAL STANDARD 595, COLOR NUMBER 33538.
3. FOR SIDEWALK EXPANSION JOINT LOCATIONS AND ADDITIONAL INFORMATION, SEE CITY STANDARD DETAIL NO. 01.02.01 & 01.02.02.
4. CURB RAMP SLOPE SHALL NOT EXCEED 8.3%, AS MEASURED BY A SMART LEVEL, UNLESS RAMP LENGTH IS EXTENDED TO 15'.

SCALE: 1"=20'



	MIN.	MAX.
D	1.6"	2.4"
E	0.65"	
F	50% OF E	65% OF E
G	0.9"	1.4"

DETECTABLE WARNING PATTERN DETAIL




SECTION (B) SCALE: 1"=5'

CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

SIDEWALK RAMP WITH COMMERCIAL APPROACHES


DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
JIM ERWIN-SVOBODA	LINDA LIAN	COLLEEN HARRIS	LINDA LIAN	01.02.19
FILE NAME: F:\DWG\COMMON\STDS\CITY\2009\01_STR\01.02\01.02.19	DATE APPROVED: 07/01/2009	DATE REVISED: 08/09/12	SCALE: VARIES	




PLAN VIEW

NOTES:

1. MAXIMUM LENGTH OF PIPE BETWEEN CATCH BASINS SHALL BE 400'.
2. TYPE I CATCH BASIN IS USED FOR DEPTHS LESS THAN 5'-0" FROM TOP OF GRATE TO I.E.(PIPE INVERT).
3. PRECAST BASE SECTION SHALL BE FURNISHED WITH CUTOUTS OR KNOCKOUTS. KNOCKOUTS SHALL HAVE A WALL THICKNESS OF 2" MIN. KNOCKOUTS SHALL BE ON 4 SIDES WITH A MAXIMUM DIAMETER OF 20" TO PROVIDE FOR A MINIMUM SUMP DEPTH OF 18".
4. THE TAPER ON THE SIDES OF THE PRECAST BASE SECTION SHALL NOT EXCEEED 1/2" PER FOOT.
5. CATCH BASIN SHALL BE CONSTRUCTED IN ACCORDANCE WITH ASTM C 478 (AASHTO M 199) AND ASTM C 890 UNLESS OTHERWISE NOTED.
6. CATCH BASIN MARKER WILL BE AFFIXED WITH MANUFACTURER'S EPOXY IN DRY WEATHER, 40 DEGREES OR WARMER. IF CURB EXISTS MARKER IS PLACED ON TOP OF CURB, IF A RAISED EDGE PLACE MARKER ON THE WEDGE, IF NO CURB PLACE ON PAVEMENT ON SIDE LEAST EXPOSED TO TRAFFIC

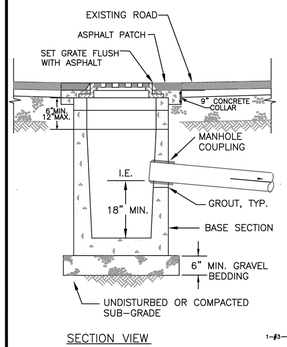

SECTION VIEW

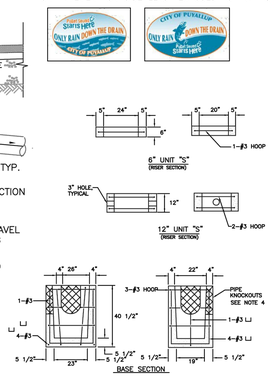


CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

CATCH BASIN TYPE 1 (AREA DRAIN)

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
LINDA LANSING		COLLEEN HARRIS	XXXX	02.01.02
FILE NAME: F:\DWG\COMMON\STDS\CITY\2009\02_SD\02.01.02	DATE APPROVED: 08/01/1992	DATE REVISED: 08/01/2003	SCALE: NTS	


CURB AND GUTTER,SEE CITY STANDARD DETAIL NO. 01.02.09 FOR ADDITIONAL INFORMATION

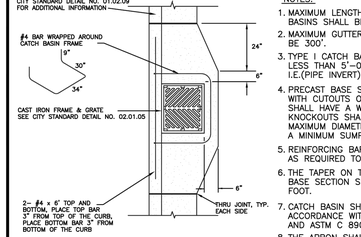


PLAN VIEW

NOTES:

1. MAXIMUM LENGTH OF PIPE BETWEEN CATCH BASINS SHALL BE 400'.
2. MAXIMUM GUTTER LINE FLOW LENGTH SHALL BE 300'.
3. TYPE I CATCH BASIN IS USED FOR DEPTHS LESS THAN 5'-0" FROM TOP OF GRATE TO I.E.(PIPE INVERT).
4. PRECAST BASE SECTION SHALL BE FURNISHED WITH CUTOUTS OR KNOCKOUTS. KNOCKOUTS SHALL HAVE A WALL THICKNESS OF 2" MIN. KNOCKOUT OR CUTOUT HOLE SIZE SHALL EQUAL THE PIPE OUTER DIAMETER PLUS THE MANHOLE WALL THICKNESS.
5. REINFORCING BARS SHALL BE CUT OR BENT AS REQUIRED TO CLEAR CUTOUTS.
6. THE TAPER ON THE SIDES OF THE PRECAST BASE SECTION SHALL NOT EXCEEED 1/2" PER FOOT.
7. CATCH BASIN SHALL BE CONSTRUCTED IN ACCORDANCE WITH ASTM C 478 (AASHTO M 199) AND ASTM C 890 UNLESS OTHERWISE NOTED.
8. THE APRON SHALL BE 8" IN DEPTH.
9. CATCH BASIN MARKER WILL BE AFFIXED WITH MANUFACTURER'S EPOXY IN DRY WEATHER, 40 DEGREES OR WARMER. IF CURB EXISTS MARKER IS PLACED ON TOP OF CURB, IF A RAISED EDGE PLACE MARKER ON THE WEDGE, IF NO CURB PLACE ON PAVEMENT ON SIDE LEAST EXPOSED TO TRAFFIC

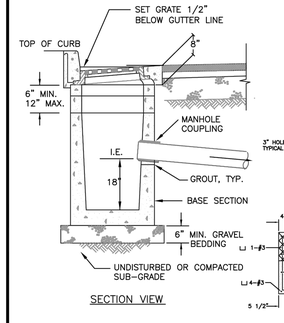

SECTION VIEW

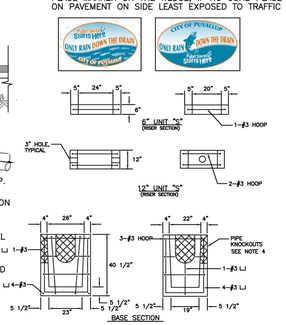


CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

CATCH BASIN TYPE 1 (GUTTER DRAIN)

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
LINDA LANSING		COLLEEN HARRIS	XXXX	02.01.03
FILE NAME: F:\DWG\COMMON\STDS\CITY\2009\02_SD\02.01.03	DATE APPROVED: 08/01/1992	DATE REVISED: 08/01/2003	SCALE: NTS	


CURB AND GUTTER,SEE CITY STANDARD DETAIL NO. 01.02.09 FOR ADDITIONAL INFORMATION

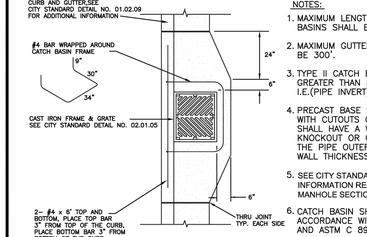

PLAN VIEW

NOTES:


1. MAXIMUM LENGTH OF PIPE BETWEEN CATCH BASINS SHALL BE 400'.
2. MAXIMUM GUTTER LINE FLOW LENGTH SHALL BE 300'.
3. TYPE II CATCH BASIN IS USED FOR DEPTHS GREATER THAN 5'-0" FROM TOP OF GRATE TO I.E.(PIPE INVERT).
4. PRECAST BASE SECTION SHALL BE FURNISHED WITH CUTOUTS OR KNOCKOUTS. KNOCKOUTS SHALL HAVE A WALL THICKNESS OF 2" MIN. KNOCKOUT OR CUTOUT HOLE SIZE SHALL EQUAL THE PIPE OUTER DIAMETER PLUS THE MANHOLE WALL THICKNESS.
5. SEE CITY STANDARD DETAIL NO. 02.01.01 FOR ADDITIONAL INFORMATION REGARDING INSTALLATION OF MANHOLE SECTION.
6. CATCH BASIN SHALL BE CONSTRUCTED IN ACCORDANCE WITH ASTM C 478 (AASHTO M 199) AND ASTM C 890 UNLESS OTHERWISE NOTED.
7. CATCH BASIN MARKER WILL BE AFFIXED WITH MANUFACTURER'S EPOXY IN DRY WEATHER, 40 DEGREES OR WARMER. IF CURB EXIST MARKER IS PLACED ON TOP OF CURB, IF A RAISED EDGE PLACE MARKER ON THE WEDGE, IF NO CURB PLACE ON PAVEMENT ON SIDE LEAST EXPOSED TO TRAFFIC

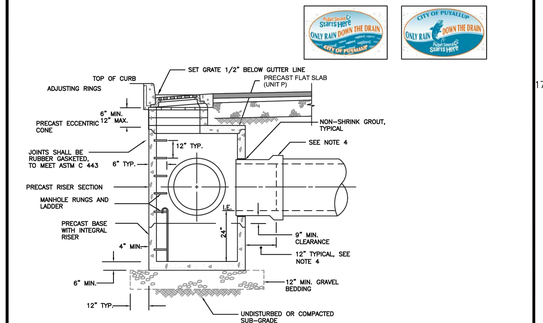


CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

CATCH BASIN TYPE II

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
LINDA LANSING		COLLEEN HARRIS	XXXX	02.01.04
FILE NAME: F:\DWG\COMMON\STDS\CITY\2009\02_SD\02.01.04	DATE APPROVED: 08/01/1992	DATE REVISED: 08/01/2003	SCALE: NTS	

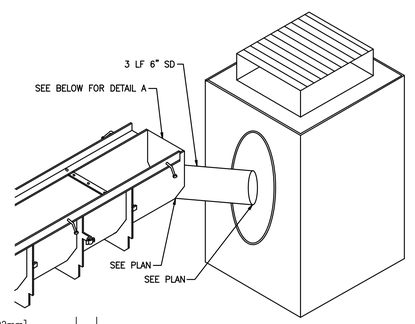

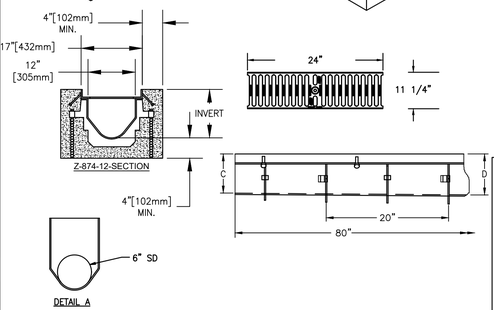

DETAIL A

TYPICAL TRENCH DRAIN DETAIL

NOT TO SCALE WITH DGE/DGF GRATE (H-20 LOADING)

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY CONSTRUCTION DETAILS**

FOR

FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER

7/16/25

Scale: Horizontal N/A Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25


Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com


Job Number 21585

Sheet C38 of 48

P:\21000s\21585\engineering\SEPA SET\21585-D.dwg 6/3/2025 11:50 AM DCASEY

PRELIMINARY CONSTRUCTION DETAILS
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

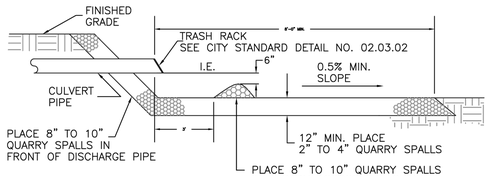

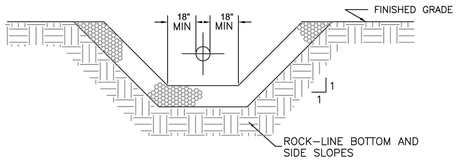


NOTE: ALL DRIVEWAY CULVERTS SHALL BE NOT LESS THAN 15 INCHES IN DIAMETER NOR LESS THAN 20 FEET IN LENGTH.

CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

DAYLIGHT CULVERT OPEN DITCH

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
LINDA LANSING	LINDA LIAN	COLLEEN HARRIS	XXXX	02.02.01
FILE NAME: P:\DWG\COMMON\STDS\CITY\200902_SD02.02.01		DATE APPROVED: 09/01/1992	DATE REVISED: 06/01/2003	SCALE: NTS

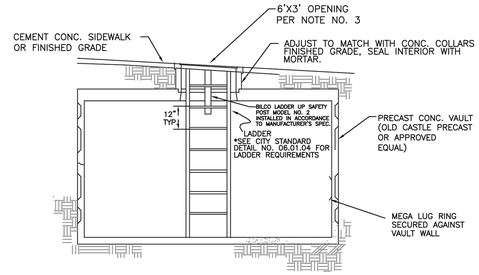


1. REMOVABLE DOORS SHALL BE A MINIMUM OF 6'–0" X 3'–0" DIAMOND PLATE HINGED LOCKING DOORS, WITH HINGES LOCATED AT EACH END OF OPENING. DOORS SHALL HAVE AN H–20 LOAD RATING IN AREAS THAT ARE SUBJECT TO VEHICLE TRAFFIC. DOORS SHALL BE SPRING LOADED WITH OPEN POSITION LOCK.
2. A LADDER PER CITY STANDARD DETAIL 06.01.04 SHALL BE SET INSIDE THE VAULT FOR ACCESS INTO THE VAULT.
3. A BILCO LADDER UP SAFETY POST MODEL NO. 2 SHALL BE ATTACHED TO THE LADDER STEPS. IT SHALL BE OF STAINLESS STEEL OR ALUMINUM CONSTRUCTION. POWDER COAT AND GALVANIZED STEEL WILL NOT BE PERMITTED.

CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

STORMWATER VAULT

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
LINDA LANSING	LINDA LIAN	COLLEEN HARRIS	Linda Lian	02.04.01
FILE NAME: P:\DWG\COMMON\STDS\CITY\200902_SD02.04.01		DATE APPROVED: 09/01/1992	DATE REVISED: 08/15/2012	SCALE: NTS

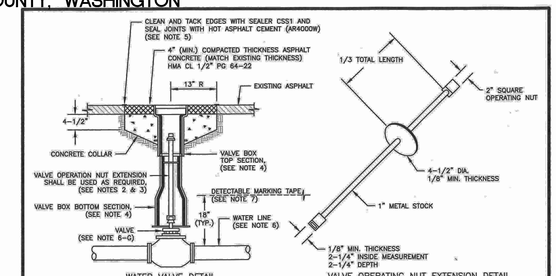


NOTES:
1. WATER MAINS SHALL HAVE A MINIMUM COVER OF 36" FROM PAVED FINAL GRADE IN IMPROVED RIGHT–OF–WAY AND IMPROVED EASEMENTS, AND A MINIMUM OF 48" IN UNIMPROVED RIGHT–OF–WAY AND UNIMPROVED EASEMENTS.
2. VALVE OPERATING NUT EXTENSIONS ARE REQUIRED WHEN THE VALVE NUT IS MORE THAN FIVE (5) FEET BELOW FINISHED GRADE. EXTENSIONS ARE TO BE A MINIMUM OF TWO (2) FEET LONG, ONLY ONE EXTENSION TO BE USED PER VALVE. TOP OF EXTENSION SHALL BE 2 FEET 6 INCHES TO 3 FEET BELOW FINISHED GRADE.
3. ALL VALVE OPERATING NUT EXTENSIONS ARE TO BE MADE OF STEEL, SIZED AS NOTED, AND PAINTED WITH TWO COATS OF METAL PAINT.
4. VALVE BOXES SHALL BE TWO–PIECE, ADJUSTABLE, CAST IRON WITH EXTENSION PIECES (IF NECESSARY), AS MANUFACTURED BY THE WANRICH #940 SEATTLE OR APPROVED EQUAL. THE WORD "WATER" SHALL BE CAST IN RELIEF ON THE VALVE BOX COVER. VALVE BOX TOPS INSTALLED IN ARTERIAL ROADWAYS SHALL BE MANUFACTURED BY EAST JORDAN (EJ) IRONWORKS MODEL 8505 WITH LOCKING VALVE BOX COVER MODEL 6800 (PART# 08800025G) OR APPROVED EQUAL.
5. NEAT LINE CUTS SHALL BE SEALED WITH A HOT PAVING GRADE ASPHALT AND FACE OF CUT TACKED.
6. WATER MAINS SHALL BE CONSTRUCTED AND TESTED IN ACCORDANCE WITH DIVISION 7 OF THE WSDOT STANDARD SPECIFICATIONS SUPPLEMENTED WITH THE FOLLOWING:
   A. DUCTILE IRON PIPE SHALL CONFORM TO AWWA C 151, THICKNESS CLASS 52, AND THE EXTERIOR SHALL BE COATED WITH COAL TAR VARNISH. PIPE AND FITTINGS SHALL BE MORTOR LINED AND SHALL CONFORM TO AWWA C 104. THE THICKNESS OF THE LINING SHALL BE NOT LESS THAN 1/16" THICK FOR 3" TO 12" PIPE, 3/32" THICK FOR 14" TO 24" PIPE, AND 1/8" THICK FOR 30" TO 54" PIPE. THE CEMENT LINING SHALL CONFORM TO THE REQUIREMENTS OF ASTM C 150.
   B. JOINTS SHALL BE TYTON PUSH–ON JOINTS, OR APPROVED EQUAL, OR MECHANICAL JOINT TYPE PER AWWA C 111 EXCEPT WHERE FLANGED JOINTS ARE REQUIRED TO CONNECT TO VALVES OR OTHER EQUIPMENT.
   C. BOLTS AND NUTS FOR BURIED FLANGES LOCATED OUTDOORS, ABOVE GROUND, OR IN OPEN VAULTS IN STRUCTURES SHALL BE TYPE 316 STAINLESS STEEL CONFORMING TO ASTM A 193, GRADE B8M FOR BOLTS, AND ASTM A 194, GRADE 8M FOR NUTS. BOLTS AND NUTS LARGER THAN ONE AND ONE–QUARTER (1–1/4) INCHES SHALL BE STEEL, ASTM A 193, GRADE B, MEDIUM PLATING, ASTM A 165, TYPE NS.
   D. BOLTS USED IN FLANGE INSTALLATION SETS SHALL CONFORM TO ASTM B 193, GRADE B7. NUTS SHALL COMPLY WITH ASTM A 194, GRADE 2H.
   E. PROVIDE A WASHER FOR EACH NUT, WHERE NEEDED. WASHERS SHALL BE OF THE SAME MATERIAL AS THE NUTS.
   F. ALL FITTINGS SHALL CONFORM TO THE REQUIREMENTS OF AWWA C 110 AND AWWA C 111.
   G. RESILIENT SEATED WEDGE GATE VALVES SHALL BE USED FOR TEN (10) INCH MAINS AND SMALLER. BUTTERFLY VALVES SHALL BE USED FOR MAINS GREATER THAN TEN (10) INCHES:
      1) RESILIENT SEATED WEDGE GATE VALVE: GATE VALVES SHALL CONFORM TO THE LATEST AWWA SPECIFICATIONS FOR COLD WATER, DOUBLE–DISK GATE VALVES, 200 PSI WORKING PRESSURE. THEY SHALL BE IRON–BODIED, BRONZE MOUNTED, NON–RISING STEM, WITH TWO (2) INCH SQUARE NUT. COUNTER–CLOCKWISE OPENING. MECHANICAL JOINT AND / OR FLANGED ENDS (6" VALVES ON FIRE HYDRANT LINES WHICH SHALL BE MECHANICAL JOINTS BY FLANGED). VALVE STEMS SHALL BE PROVIDED WITH O–RING SEALS AND SHALL BE AS MANUFACTURED BY THE MUELLER COMPANY OR APPROVED EQUAL.
      2) BUTTERFLY VALVES: BUTTERFLY VALVES CONFORMING WITH AWWA C 504, CLASS 150 AND SHALL HAVE STANDARD AWWA TWO (2) INCH SQUARE NUT.
7. DETECTABLE MARKING TAPE SHALL BE INSTALLED 18" ABOVE PIPE, BE BLUE IN COLOR, AND READ "CAUTION WATER LINE BELOW" MEETING WSDOT SPEC. 9–15.18.

CITY OF PUYALLUP
OFFICE of THE CITY ENGINEER

APPROVED FOR PUBLICATION — DATE SEALED: 12/10/2021

WATER VALVES AND MAINS

CITY STANDARD 03.01.01
(NOT TO SCALE)
FILE NAME: P:\DWG\COMMON\STDS\CITY\200902_SD03.01.01

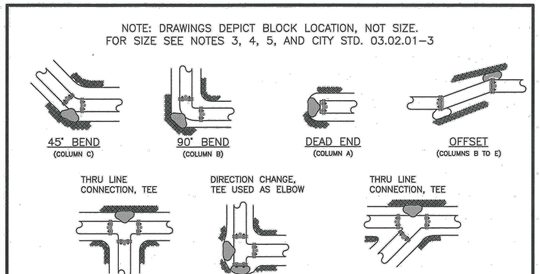


NOTES:
1. THE FOLLOWING PRECAUTIONS MUST BE OBSERVED WHEN CONSTRUCTING THRUST BLOCKS:
   A. BLOCKS MUST BE POURED OR PLACED AGAINST UNDISTURBED SOIL.
   B. THE PIPE FITTING(S) AND BOLTS MUST BE ACCESSIBLE. WRAP IN PLASTIC BEFORE POURING CONCRETE BLOCKING.
   C. CONCRETE SHOULD BE CURED FOR AT LEAST 5 DAYS AND SHOULD HAVE A MINIMUM COMPRESSION STRENGTH OF 3,000 PSI AT 28 DAYS.
   D. RESTRAINED JOINTS SHALL BE INSTALLED, IN ADDITION TO CONCRETE THRUST BLOCKING.
   E. BLOCKS MUST BE POSITIONED TO COUNTERACT THE DIRECTION OF THE RESULTANT THRUST FORCE.
2. ALL PIPE SHALL BE PROPERLY BEDDED, SEE CITY OF PUYALLUP STANDARD BEDDING DETAIL NO. 06.01.01.
3. CONTRACTOR TO PROVIDE BLOCKING ADEQUATE TO WITHSTAND FULL TEST PRESSURE.
4. DIVIDE THRUST BY SAFE BEARING LOAD TO DETERMINE REQUIRED AREA (IN SQUARE FEET) OF CONCRETE TO DISTRIBUTE LOAD.
5. BEARING SURFACE AREAS TO BE ADJUSTED BY THE ENGINEER FOR OTHER PRESSURE AND/OR SOIL CONDITIONS.

CITY OF PUYALLUP
OFFICE of THE CITY ENGINEER

APPROVED FOR PUBLICATION — DATE SEALED: 2/5/2013

HORIZONTAL THRUST BLOCKING

CITY STANDARD 03.02.01-1
(NOT TO SCALE)
FILE NAME: P:\DWG\COMMON\STDS\CITY\200902_SD02.01.01-1

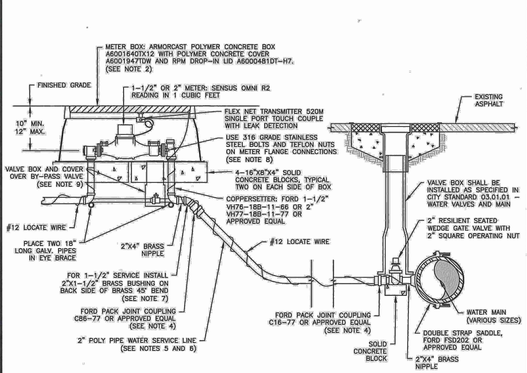


NOTES:
1. ALL MATERIALS AND FITTINGS SHALL BE AS SPECIFIED OR AN APPROVED EQUAL.
2. NORMALLY THE WATER METER BOX SHOULD BE LOCATED IN THE PLANTING STRIP. IF SIDEWALK IS AGAINST THE CURB, PLACE METER BOX DIRECTLY BEHIND THE SIDEWALK. THE WATER METER BOX SHALL NOT BE LOCATED IN HARD SURFACES. WHEN UNAVOIDABLE, EXCEPTIONS CAN BE MADE AT END OF CUL–DE–SACS OR PAN HANDLED LOTS.
3. WATER MAINS SHALL HAVE A MINIMUM COVER OF 36" IN IMPROVED RIGHT–OF–WAY AND IMPROVED EASEMENTS, AND A MINIMUM OF 48" IN UNIMPROVED RIGHT–OF–WAY AND UNIMPROVED EASEMENTS.
4. ALL POLY PIPE COUPLINGS SHALL USE PIPE INSERT STIFFENERS.
5. THE WATER SERVICE LINE SHALL BE BEDDED IN WASHED SAND WITH 36" OF COVER BELOW FINISHED GRADE WITHIN THE RIGHT–OF–WAY. THE WATER SERVICE LINE SHALL BE ONE CONTINUOUS PIECE WITH NO SPLICES.
6. ALL POLY PIPE SHALL BE HIGH DENSITY POLY (IRON PIPE SIZE) MEETING ASTM D–2239–SIDR 7, BLUE IN COLOR, 200 PSI MINIMUM.
7. FOR A 1–1/2" WATER SERVICE, ALL MATERIAL SHALL BE 2" FROM THE WATER MAIN TO THE COPPERSETTER. REDUCE FROM 2" TO 1–1/2" IMMEDIATELY BEFORE COPPERSETTER.
8. THE STAINLESS STEEL METER FLANGE BOLTS SHALL BE 5/8" DIAMETER FOR THE 1–1/2" METER, AND 3/4" DIAMETER FOR THE 2" METER.
9. PROVIDE A 6" CIRCULAR VALVE BOX WITH COVER (APPLIED ENGINEERING PRODUCT MODEL 708 WITH GREEN LID OR AN APPROVED EQUAL) OVER BY–PASS VALVE.

CITY OF PUYALLUP
OFFICE of THE CITY ENGINEER

APPROVED FOR PUBLICATION — DATE SEALED: 10/15/2019

1-1/2" AND 2" WATER SERVICE CONNECTION

CITY STANDARD 03.03.02
(NOT TO SCALE)
FILE NAME: P:\DWG\COMMON\STDS\CITY\200902_SD03.02.01

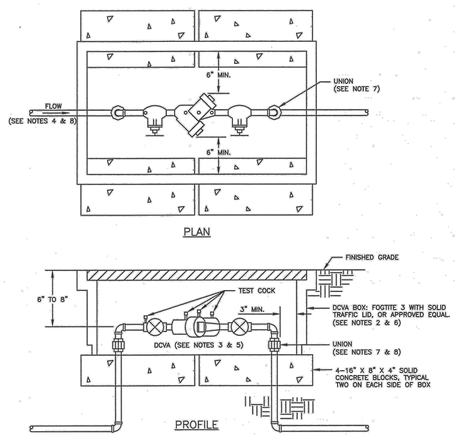


NOTES:
1. BACKFLOW ASSEMBLY MUST BE SELECTED FROM WASHINGTON STATE DEPARTMENT OF HEALTH'S LIST OF BACKFLOW PREVENTION ASSEMBLIES APPROVED FOR INSTALLATION IN WASHINGTON STATE, LATEST EDITION.
2. THE DCVA SHALL BE INSTALLED WITH ADEQUATE SPACE TO FACILITATE MAINTENANCE AND TESTING. IT SHALL BE TESTED AFTER INSTALLATION, BY A WASHINGTON STATE CERTIFIED BACK–FLOW ASSEMBLY TESTER, TO INSURE ITS SATISFACTORY OPERATION BEFORE OCCUPANCY, AND ANNUALLY THEREAFTER. SEND TEST RESULTS TO: CITY OF PUYALLUP, WATER QUALITY OPERATIONS, 1100 39TH AVE SE, PUYALLUP, WA 98374.
3. DCVA MUST BE PURCHASED AS A UNIT. NO MODIFICATIONS TO THE ASSEMBLY ARE ALLOWED.
4. DCVA SHALL BE PLACED IMMEDIATELY DOWNSTREAM OF WATER METER. WHEN IRRIGATION SYSTEM IS CONNECTED OFF DOMESTIC WATER LINE, IRRIGATION DCVA SHALL BE PLACED IMMEDIATELY DOWNSTREAM OF THE BRANCH CONNECTION.
5. DCVA SHALL BE SIZED EQUAL OR COMPARABLE TO METER SIZE.
6. METER BOX SHALL BE LARGE ENOUGH TO ALLOW THE MINIMUM SETBACKS ILLUSTRATED ABOVE. METER BOX LID SHALL BE A TRAFFIC LID WITH A H–20 LOADING.
7. DIELECTRIC UNIONS MUST BE USED TO SEPARATE DISSIMILAR MATERIALS.
8. USE ONLY BRASS OR COPPER BETWEEN THE METER AND THE UNION ON THE CUSTOMER'S SIDE OF THE DCVA.

CITY OF PUYALLUP
OFFICE of THE CITY ENGINEER

APPROVED FOR PUBLICATION — DATE SEALED: 2/5/2013

2" AND SMALLER DOUBLE CHECK VALVE ASSEMBLY INSTALLATION

CITY STANDARD 03.04.01
(NOT TO SCALE)
FILE NAME: P:\DWG\COMMON\STDS\CITY\200902_SD04.01.01

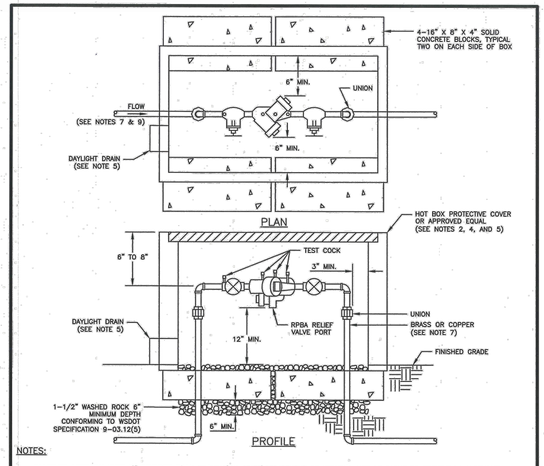

NOTES:
1. BACKFLOW ASSEMBLY MUST BE SELECTED FROM WASHINGTON STATE DEPARTMENT OF HEALTH'S LIST OF BACKFLOW PREVENTION ASSEMBLIES APPROVED FOR INSTALLATION IN WASHINGTON STATE, LATEST EDITION.
2. THE RPBA SHALL BE INSTALLED WITH ADEQUATE SPACE TO FACILITATE MAINTENANCE AND TESTING. IT SHALL BE TESTED AFTER INSTALLATION, BY A WASHINGTON STATE CERTIFIED BACK–FLOW ASSEMBLY TESTER, TO INSURE ITS SATISFACTORY OPERATION BEFORE OCCUPANCY, AND ANNUALLY THEREAFTER. SEND TEST RESULTS TO: CITY OF PUYALLUP, WATER QUALITY OPERATIONS, 1100 39TH AVE SE, PUYALLUP, WA 98374.
3. THE RPBA MUST BE PURCHASED AS A UNIT. NO MODIFICATIONS TO THE ASSEMBLY ARE ALLOWED.
4. THE RPBA SHALL NOT BE INSTALLED IN A PIT BELOW GROUND LEVEL.
5. THE PROTECTIVE COVERING FOR THE RPBA, WHICH PROTECTS THE ASSEMBLY FROM FREEZING, MUST INCLUDE A DAYLIGHT DRAIN. THE DRAIN MUST BE INSTALLED ABOVE GROUND OR ABOVE THE MAXIMUM FLOOD LEVEL, WHICHEVER IS HIGHER. THE DRAIN MUST BE A MINIMUM OF TWICE THE SIZE OF THE RPBA, TO BE ABLE TO HANDLE THE VOLUME OF WATER THAT POTENTIALLY COULD BE DISCHARGED FROM THE RELIEF VALVE PORT.
6. THE RPBA SHALL BE SIZED EQUAL OR COMPARABLE TO THE METER SIZE.
7. USE ONLY BRASS OR COPPER BETWEEN THE METER AND THE BOTTOM VERTICAL 90 DEGREE BEND ON THE CUSTOMER'S SIDE OF THE RPBA.
8. DIELECTRIC UNIONS MUST BE USED TO SEPARATE DISSIMILAR MATERIALS.
9. THE RPBA SHOULD BE LOCATED IMMEDIATELY DOWN STREAM OF THE METER, AND SHOULD NOT BE INSTALLED INSIDE A BUILDING.
10. AN RPBA INSTALLED MORE THAN FIVE (5) FEET ABOVE FLOOR LEVEL MUST HAVE A PLATFORM UNDER IT FOR THE TESTER OR MAINTENANCE PERSON TO STAND ON. THE PLATFORM MUST BE OSHA APPROVED AND MEET ALL APPLICABLE SAFETY STANDARDS AND CODES.

CITY OF PUYALLUP
OFFICE of THE CITY ENGINEER

APPROVED FOR PUBLICATION — DATE SEALED: 2/5/2013

2" AND SMALLER REDUCED PRESSURE BACKFLOW ASSEMBLY INSTALLATION

CITY STANDARD 03.04.02
(NOT TO SCALE)
FILE NAME: P:\DWG\COMMON\STDS\CITY\200902_SD04.02.01

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY CONSTRUCTION DETAILS**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

STATE OF WASHINGTON — JASON S. MCAREAVEY — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25


Scale: Horizontal N/A Vertical N/A
Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585
Sheet C39 of 48


P:\21000s\21585\engineering\SEPA SET\21585-D.dwg 6/3/2025 11:50 AM DCASEY

PRELIMINARY CONSTRUCTION DETAILS
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

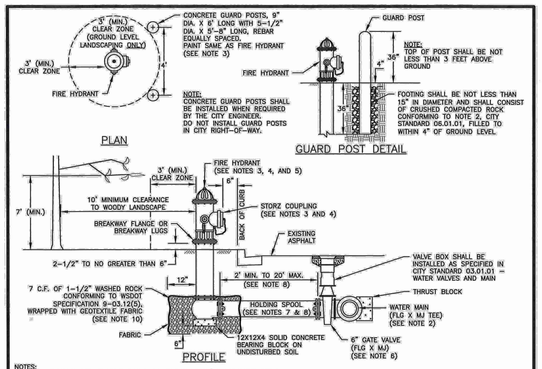

NOTES:
1. ALL MATERIALS AND FITTINGS SHALL BE AS SPECIFIED OR APPROVED EQUAL.
2. WATER MAINS SHALL HAVE A MINIMUM COVER OF 36" IN IMPROVED RIGHT-OF-WAY AND IMPROVED EASEMENTS, AND A MINIMUM 48" IN UNIMPROVED RIGHT-OF-WAY AND UNIMPROVED EASEMENTS.
3. THE FIRE HYDRANT AND CONCRETE GUARD POSTS SHALL BE PAINTED, RUST-OLEUM SAFETY YELLOW #7543 (TWO COATS) OR AN APPROVED EQUAL. THE STORZ FITTING SHALL NOT BE PAINTED.
4. FIRE HYDRANTS SHALL HAVE TWO 2-1/2" HOSE PORTS (NATIONAL STANDARD THREAD) WITH CAPS AND CHAINS AND ONE 4" PUMPER PORT (#8 TACOMA STEAMER PORT THREAD) WITH A 5" "STORZ" COUPLING AND BLIND CAP INSTALLED ON THE STEAMER PORT, (STEAMER PORT SHALL FACE THE STREET), 1-1/4" PENTAGONAL OPERATING NUT (COUNTER-CLOCKWISE OPENING), O-RING TYPE STUFFING BOX, AUTOMATIC BARREL DRAINS AND 5-1/4" MAIN VALVE OPENING. HYDRANTS SHALL BE DESIGNED IN A MANNER THAT WILL PREVENT BARREL BREAKAGE WHEN STRUCK BY A VEHICLE. HYDRANTS SHALL CONFORM TO THE LATEST REVISION OF AWWA SPECIFICATIONS NO. C 502-73 FOR FIRE HYDRANTS FOR ORDINARY WATER SERVICE. FIRE HYDRANTS SHALL INCLUDE THE ENTIRE ASSEMBLY COMPLETE, INCLUDING HYDRANT, GATE VALVE AND BOX, CONNECTING PIPING, FITTINGS, AND ACCESSORIES.
5. FIRE HYDRANTS SHALL BE AVK, CLOW MEDALLION, M & H 1285, MUELLER CENTURION, OR WATEROUS.
6. GATE VALVES SHALL CONFORM TO THE LATEST AWWA SPECIFICATIONS FOR COLD WATER, RESILIENT SEATED WEDGE GATE VALVES, 200 PSI WORKING PRESSURE. THEY SHALL BE IRON-BODIED BRONZE-MOUNTED, NON-RISING STEM, COUNTER-CLOCKWISE OPENING, MECHANICAL JOINT BY FLANGED. VALVE STEMS SHALL BE PROVIDED WITH O-RING SEALS AND SHALL BE AS MANUFACTURED BY THE MUELLER COMPANY OR APPROVED EQUAL.
7. THE HOLDING SPOOL SHALL BE A MECHANICAL-JOINT (M.J.) HOLDING SPOOL, WITH THE USE OF MEGA-LUG CONNECTORS OR APPROVED EQUAL WITH CLASS 52 DUCTILE IRON PIPE.
8. IF DISTANCE BETWEEN WATER MAIN AND FIRE HYDRANT IS GREATER THAN 17 FEET, RESTRAINED JOINTS ARE REQUIRED ON ANY ADDITIONAL JOINTS. THE MAXIMUM 6-INCH HYDRANT RUN ALLOWED IS 20 FEET. ANY PROPOSED HYDRANT RUN EXCEEDING 20' IN LENGTH SHALL BE SIZED USING AN ENGINEERED HYDRAULIC FIRE FLOW MODEL. ANY HYDRANT RUN EXCEEDING 50 FEET IN LENGTH SHALL BE NO LESS THAN 8-INCHES IN DIAMETER.
9. FIRE HYDRANTS SHALL BE LOCATED A MINIMUM OF 50 FEET FROM A BUILDING OR STRUCTURE.
10. THE CONTRACTOR SHALL PLACE A 6 OZ. GEOTEXTILE FABRIC AROUND THE WASHED ROCK AREA, ENDS TO OVERLAP.
11. A FLUORESCENT ORANGE BAG MUST COVER AND BE SECURED TO THE FIRE HYDRANT UNTIL APPROVED FOR USE BY CITY ENGINEER.
12. A MINIMUM THREE FOOT (3') RADIUS UNOBSTRUCTED CLEAR ZONE (WORK AREA) SHALL BE PROVIDED AROUND ALL FIRE HYDRANTS. ADDITIONALLY, NO WOODY LANDSCAPE SHALL BE PLANTED WITHIN TEN FEET (10') OF ANY FIRE HYDRANT. OVERREACHING BRANCHES OF TREES ADJACENT TO HYDRANTS SHALL HAVE A MAINTAINED VERTICAL CLEARANCE OF SEVEN (7') FEET ABOVE FINISHED GRADE OF THE FIRE HYDRANT.

CITY OF PUYALLUP — OFFICE of THE CITY ENGINEER | APPROVED FOR PUBLICATION | DATE SIGNED 11/17/2025 | **FIRE HYDRANT ASSEMBLY** | (NOT TO SCALE) | CITY STANDARD 03.05.01

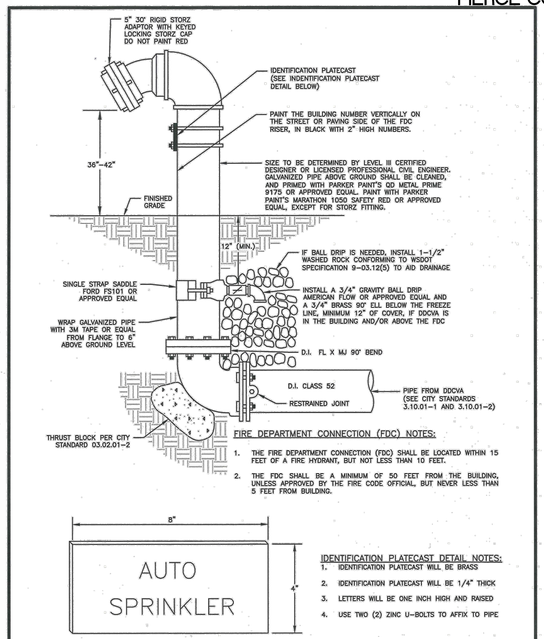


FIRE DEPARTMENT CONNECTION (FDC) NOTES:
1. THE FIRE DEPARTMENT CONNECTION (FDC) SHALL BE LOCATED WITHIN 15 FEET OF A FIRE HYDRANT, BUT NOT LESS THAN 10 FEET.
2. THE FDC SHALL BE A MINIMUM OF 50 FEET FROM THE BUILDING, UNLESS APPROVED BY THE FIRE CODE OFFICIAL, BUT NEVER LESS THAN 5 FEET FROM BUILDING.

IDENTIFICATION PLATECAST DETAIL


IDENTIFICATION PLATECAST DETAIL NOTES:
1. IDENTIFICATION PLATECAST WILL BE BRASS
2. IDENTIFICATION PLATECAST WILL BE 1/4" THICK
3. LETTERS WILL BE ONE INCH HIGH AND RAISED
4. USE TWO (2) ZINC U-BOLTS TO AFFIX TO PIPE

CITY OF PUYALLUP — OFFICE of THE CITY ENGINEER | APPROVED FOR PUBLICATION | DATE SIGNED 2/5/2018 | **FIRE DEPARTMENT CONNECTION (FDC)** | (NOT TO SCALE) | CITY STANDARD 03.10.02

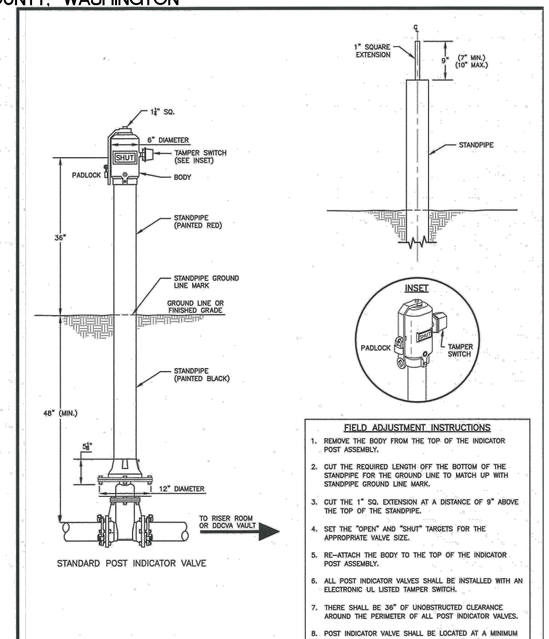

FIELD ADJUSTMENT INSTRUCTIONS
1. REMOVE THE BODY FROM THE TOP OF THE INDICATOR POST ASSEMBLY.
2. CUT THE REQUIRED LENGTH OFF THE BOTTOM OF THE STANDPIPE FOR THE GROUND LINE TO MATCH UP WITH STANDPIPE GROUND LINE MARK.
3. CUT THE 1" SQ. EXTENSION AT A DISTANCE OF 9" ABOVE THE TOP OF THE STANDPIPE.
4. SET THE "OPEN" AND "SHUT" TARGETS FOR THE APPROPRIATE VALVE SIZE.
5. RE-ATTACH THE BODY TO THE TOP OF THE INDICATOR POST ASSEMBLY.
6. ALL POST INDICATOR VALVES SHALL BE INSTALLED WITH AN ELECTRONIC UL LISTED TAMPER SWITCH.
7. THERE SHALL BE 36" OF UNOBSTRUCTED CLEARANCE AROUND THE PERIMETER OF ALL POST INDICATOR VALVES.
8. POST INDICATOR VALVE SHALL BE LOCATED AT A MINIMUM 5-ft FROM BUILDING.


CITY OF PUYALLUP — OFFICE of THE CITY ENGINEER | APPROVED FOR PUBLICATION | DATE SIGNED 2/5/2018 | **POST INDICATOR VALVE** | (NOT TO SCALE) | CITY STANDARD 03.10.03

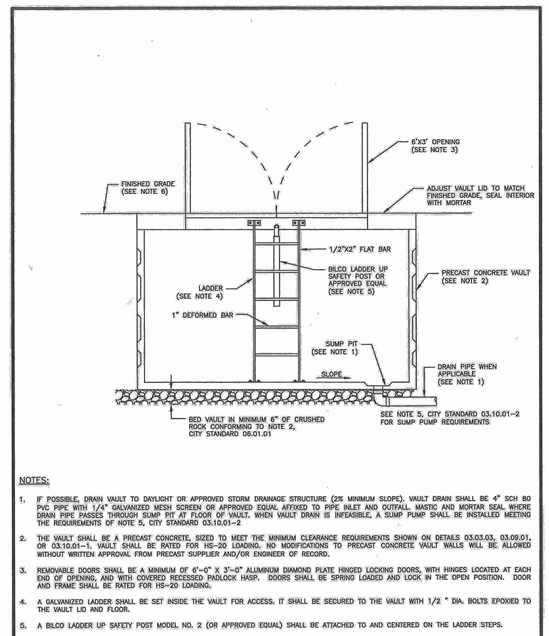


NOTES:
1. IF POSSIBLE, DRAIN VAULT TO DAYLIGHT OR APPROVED STORM DRAINAGE STRUCTURE (2% MINIMUM SLOPE). VAULT DRAIN SHALL BE 4" SCH 80 PVC PIPE WITH 1/4" GALVANIZED MESH SCREEN OR APPROVED EQUAL AFFIXED TO PIPE INLET AND OUTFALL MASTIC AND MORTAR SEAL WHERE DRAIN PIPE PASSES THROUGH SUMP PIT AT FLOOR OF VAULT. WHEN VAULT DRAIN IS INFEASIBLE, A SUMP PUMP SHALL BE INSTALLED MEETING THE REQUIREMENTS OF NOTE 5, CITY STANDARD 03.10.01-2
2. THE VAULT SHALL BE A PRECAST CONCRETE, SIZED TO MEET THE MINIMUM CLEARANCE REQUIREMENTS SHOWN ON DETAILS 03.02.03, 03.09.01, OR 03.10.01-1. VAULT SHALL BE RATED FOR HS-20 LOADING. NO MODIFICATIONS TO PRECAST CONCRETE VAULT WALLS WILL BE ALLOWED WITHOUT WRITTEN APPROVAL FROM PRECAST SUPPLIER AND/OR ENGINEER OF RECORD.
3. REMOVABLE DOORS SHALL BE A MINIMUM OF 6'-0" X 3'-0" ALUMINUM DIAMOND PLATE HINGED LOCKING DOORS, WITH HINGES LOCATED AT EACH END OF OPENING, AND WITH COVERED RECESSED PADLOCK HASP. DOORS SHALL BE SPRING LOADED AND LOCK IN THE OPEN POSITION. DOOR AND FRAME SHALL BE RATED FOR HS-20 LOADING.
4. A GALVANIZED LADDER SHALL BE SET INSIDE THE VAULT FOR ACCESS. IT SHALL BE SECURED TO THE VAULT WITH 1/2 " DIA. BOLTS EPOXIED TO THE VAULT LID AND FLOOR.
5. A BILCO LADDER UP SAFETY POST MODEL NO. 2 (OR APPROVED EQUAL) SHALL BE ATTACHED TO AND CENTERED ON THE LADDER STEPS.
6. THE VAULT SHALL BE PLACED IN A UTILITY EASEMENT OUT OF VEHICLE AND PEDESTRIAN TRAFFIC.
7. CAST-IN-PLACE VAULTS SHALL BE PERMITTED BY THE CITY'S BUILDING DIVISION PRIOR TO CONSTRUCTION.

CITY OF PUYALLUP — OFFICE of THE CITY ENGINEER | APPROVED FOR PUBLICATION | DATE SIGNED 10/15/2019 | **WATER VAULT DETAILS** | (NOT TO SCALE) | CITY STANDARD 03.11.01

NOTES:
1. NEAT LINE CUTS SHALL BE SEALED AT TOP WITH A HOT PAVING GRADE AND FACE OF CUT TACKED.
2. TOP OF SHELF, SLOPE 1/2" PER FOOT, CONSTRUCT IN FIELD CHANNEL AND SHELF TO THE CROWN OF PIPE.




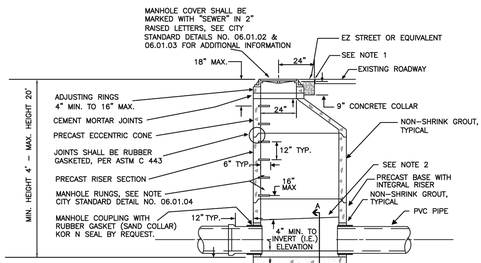


CITY OF PUYALLUP — DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
JIM ERWIN-SVOBODA	LINDA LIAN	COLLEEN HARRIS		04.01.01
FILE NAME: F:\DWG\COMMON\STDSCITY\200904_SS04.01.04.01.01	DATE APPROVED: 07/01/2009	DATE REVISED: 10/23/12	SCALE: 1"=4'	

SANITARY SEWER MANHOLE

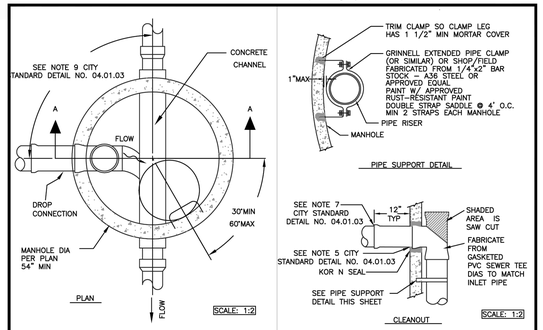

* WHEN RETRO-FITTING A 48" MANHOLE DROP MUST BE INSTALLED ON LADDER SIDE OF MANHOLE.*

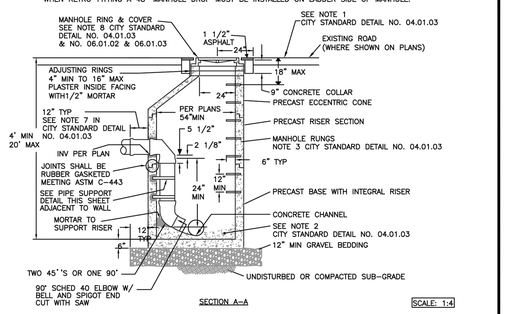

CITY OF PUYALLUP — DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
JIM ERWIN-SVOBODA	LINDA LIAN	COLLEEN HARRIS		04.01.02
FILE NAME: F:\DWG\COMMON\STDSCITY\200904_SS04.01.04.01.02	DATE APPROVED: 07/01/2009	DATE REVISED: 04/23/2009	SCALE: NARRS	

INSIDE DROP SANITARY SEWER MANHOLE

NOTES FOR: INSIDE DROP SANITARY SEWER MANHOLE

1. NEAT LINE CUTS SHALL BE SEALED AT TOP WITH A HOT PAVING GRADE ASPHALT AND FACE OF CUT TACKED. ASPHALT DEPTH TO MATCH EXISTING.
2. TOP OF SHELF, SLOPE 1/2" PER FOOT MINIMUM, CONSTRUCT IN FIELD CHANNEL AND SHELF TO THE CROWN OF PIPE.
3. MANHOLE RUNG SHALL CONFORM TO SECTION R, ASTM C 478 (AASHTO M-199) AND MEET ALL OSHA REQUIREMENTS. MANHOLE RUNGS SHALL BE PARALLEL OR APPROXIMATELY RADIAL AT THE OPTION OF THE MANUFACTURER, EXCEPT THAT ALL STEPS IN ANY MANHOLE SHALL BE SIMILAR. PENETRATION OF OUTER WALL BY A LEG IS PROHIBITED. SEE CITY STANDARD DETAIL NO. 06.01.04 & 06.01.05
4. PRECAST BASES SHALL BE FURNISHED WITH CUTOUTS OR KNOCKOUTS. KNOCKOUTS SHALL HAVE A WALL THICKNESS OF 2" MINIMUM. DROP INLET PIPE HOLE MAY BE FIELD CONSTRUCTED.
5. KNOCKOUT OR CUTOUT HOLE SIZE IS EQUAL TO PIPE OUTER DIAMETER PLUS MANHOLE WALL THICHNESS. MINIMUM DISTANCE BETWEEN HOLES IS 8".
6. PRECAST CONCRETE MANHOLE COMPONENTS SHALL CONFORM TO ASTM C 478.
7. FLEXIBLE JOINTS SHALL BE RUBBER GASKETED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS. MORTARED, DRY-PACKED, OR CAST-IN-PLACE JOINTS WILL BE PERMITTED ONLY FOR CONNECTIONS TO OR THROUGH MANHOLES. A FLEXIBLE GASKETED JOINT SHALL BE INSTALLED WITHIN ONE (1) FOOT OF EACH CONNECTION TO MANHOLES. CONNECTIONS TO MANHOLE SHALL UTILIZE A KOR N SEAL CONNECTION MORTARED. CONNECTIONS TO THESE STRUCTURES WITH PVC PIPE SHALL UTILIZE A MANHOLE COUPLING AND RUBBER GASKET.
8. MANHOLE RING AND COVER: THE COVER SHALL BE MARKED WITH "SEWER" IN TWO (2) INCH RAISED LETTERS (SEE CITY STANDARD DETAILS NO. 06.01.02 AND 06.01.03 FOR ADDITIONAL INFORMATION).
9. THE MAXIMUM CHANGE IN FLOW DIRECTION IN MANHOLES SHALL BE 90 DEGREES. FOR ALL CHANGES IN FLOW DIRECTION GREATER THAN 45 DEGREES, A MINIMUM DROP OF 0.10 FEET BETWEEN INVERTS SHALL BE PROVIDED AND CHANNELIZATION PROVIDED.

CITY OF PUYALLUP — DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
JIM ERWIN-SVOBODA	LINDA LIAN	COLLEEN HARRIS	XXXX	04.01.03
FILE NAME: F:\DWG\COMMON\STDSCITY\200904_SS04.01.04.01.03	DATE APPROVED: 07/01/2009	DATE REVISED: XX/XX/XX	SCALE: NARRS	

INSIDE DROP SANITARY SEWER MANHOLE (NOTES)

APPROVED
BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING
DATE _____
NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY CONSTRUCTION DETAILS**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCAREE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25


Scale: Horizontal N/A Vertical N/A
Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585
Sheet C40 of 48

P:\21000s\21585\engineering\SEPA SET\21585-D.dwg 6/3/2025 11:50 AM DCASEY

PRELIMINARY CONSTRUCTION DETAILS
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

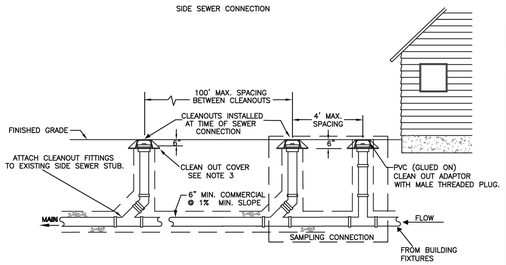

NOTES:


1. SAMPLING CONNECTION SHALL BE INSTALLED OUT SIDE WITH UNOBSTRUCTED ACCESS AT ALL TIMES.
2. A SAMPLING CONNECTION SHALL BE INSTALLED FOR EACH COMMERCIAL / RETAIL UNIT OR SPACE.
3. CLEAN OUT AND SAMPLING CONNECTION COVERS:
   A) FOR NON-VEHICULAR TRAFFIC INSTALLATIONS USE "CARSON" MODEL 910 GREEN YARD BOX WITH BOLT DOWN LID MARKED SEWER OR APPROVED EQUAL.
   B) FOR ASPHALT, GRAVEL, OR TRAFFIC INSTALLATIONS SEE CITY STANDARD DETAIL NO. 04.03.05 FRAME AND COVER SECTION.
4. EACH CLEANOUT ASSEMBLY SHALL CONSIST OF: ONE CLEANOUT ADAPTER, HUB x FEMALE, FIPT, PVC SI AND ONE CLEANOUT PLUG, MOPT WITH RAISED NUT, PVC SDR35.

CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS


COMMERCIAL SIDE SEWER CONNECTION WITH SAMPLING CONNECTION

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY		CITY STANDARD
JSM EWEN-SVOBODA	LINDA LIAN	COLLEEN HARRIS	LINDA LIAN		
FILE NAME: F:\DWG\COMMON\STD\CITY\2009\04_SS\04.03.04.DWG		DATE APPROVED: 09/01/2009	DATE REVISED: 04/23/21	SCALE: NO SCALE	04.03.04

STANDARD BLACK VINYL CHAIN LINK FENCING TO BE USED FOR PUBLIC RIGHT OF WAY WHEN NECESSARY.

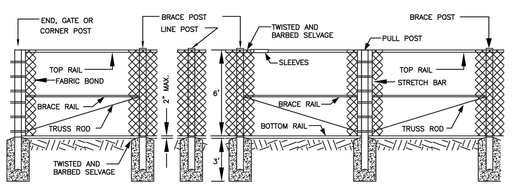

CHAIN LINK FENCE TYPE 1 — SCALE: 1:5

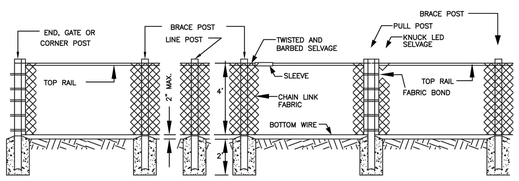

CHAIN LINK FENCE TYPE 6

NOTES:


1. ALL CHAIN LINK FENCE SHALL BE TYPE 6 FORTY-EIGHT (48") AS PER WSDOT STANDARD PLAN L-2, BOTTOM AND TOP, BRACE POST AND CHAIN LINK. BOTTOM AND TOP SHALL HAVE A BLACK VINYL COATING. SPECIFICATIONS – NOTE 3.
2. CHAIN LINK GATE SHALL BE AS SHOWN IN WSDOT STANDARD PLAN L-3. PER SECTION 9-16.1(1) AND AS AMENDED BY NOTE #3.
3. SECTION 9-16.1(1) SHALL BE SUPPLEMENTED WITH THE FOLLOWING: IN ADDITION TO MEETING THE COATING AND MATERIAL REQUIREMENTS OF SECTION 9-16 OF THE STANDARD SPECIFICATIONS, ALL FENCE AND GATE PARTS OF FENCE NOTED AS VINYL COATED SHALL HAVE A BLACK VINYL CLAD COATING AND ALL PARTS MATCH IN COLOR. COATING OF FABRIC SHALL BE EXTRUDED/BONDED OF 0.015 INCH THICKNESS. COATING FOR POSTS AND RAILS SHALL BE 3 MIL POWDER COAT. ALL BOLTS NUTS, AND WIRE TIES SHALL BE POWDER COATED TO MATCH THE COLOR OF THE FENCE FABRIC.
4. FENCE PLACEMENT AND LOCATION REQUIRES CITY ENGINEER APPROVAL. PLACEMENT IS INTENDED FOR AREAS THAT HAVE VERTICAL DROPS GREATER THAN THREE FEET AND TO DIVIDE PUBLIC AND PRIVATE PROPERTY AT RIGHT OF WAY LINE.

SCALE: 1:4

CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

CHAIN LINK FENCE TYPE 1 AND TYPE 6

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY		CITY STANDARD
JSM EWEN-SVOBODA	LINDA LIAN	COLLEEN HARRIS	XXXX		
FILE NAME: F:\DWG\COMMON\STD\CITY\2009\06_MISC\06.01.08.01.08		DATE APPROVED: 09/01/2009	DATE REVISED: XX/XX/XX	SCALE: VARIES	06.01.08

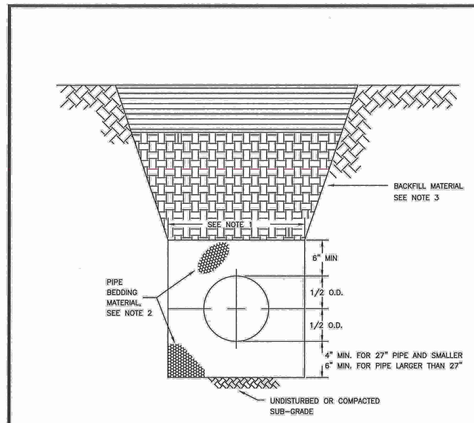

1. TRENCHING SHALL MEET THE REQUIREMENTS OF SECTION 7-08.3(1)A AND 2-06.3(1) OF THE WSDOT SPECIFICATIONS.
2. BEDDING MATERIAL SHALL CONFORM TO 9-03.12(3) GRAVEL BACKFILL FOR PIPE ZONE BEDDING.
3. GRAVEL BACKFILL SHALL CONFORM TO 9-03.12(1)A GRAVEL BACKFILL FOR FOUNDATIONS, CLASS A.


CITY OF PUYALLUP
OFFICE of THE CITY ENGINEER

PIPE TRENCHING BEDDING AND BACKFILL


DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	DATE REVISED	CITY STANDARD
JSM EWEN-SVOBODA	TED HILL	MARK PALMER	V STOCKSIAN	10/23/13	
FILE NAME: F:\DWG\COMMON\STD\CITY\STD9\06_MISC\06.01.01.DWG		DATE APPROVED: 03/01/2009	SCALE: NO SCALE	03/31/15 XX/XX/XX XX/XX/XX	06.01.01

ISSUE DATE: 3/17/17

EAST JORDAN IRON WORKS 24" "ERGO" FRAME & COVER (PRE-APPROVED PRODUCT)

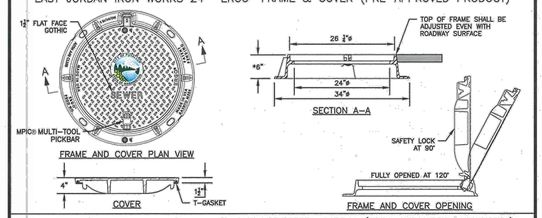

OLYMPIC FOUNDRY MH41 RING & HINGE PUYALLUP COVER (PRE-APPROVED PRODUCT)

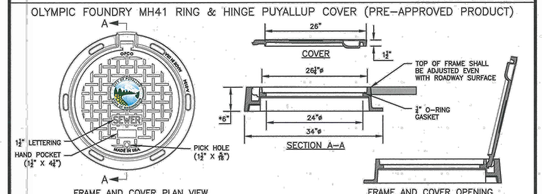

NOTES:

1. EAST JORDAN IRON WORKS 24" "ERGO" AND OLYMPIC FOUNDRY MH41 RING & HINGE PUYALLUP COVER ARE PRE-APPROVED PRODUCTS AND SHALL BE USED FOR PUBLICLY-OWNED INFRASTRUCTURE. ALL OTHERS REQUIRE WRITTEN APPROVAL OF THE ENGINEER PRIOR TO INSTALLATION.
2. MANHOLE FRAME AND COVERS SHOULD NOT BE LOCATED IN PEDESTRIAN PATHWAYS (E.G. SIDEWALKS, CROSSWALKS, ETC.). WHERE EXISTING OR PROPOSED CONDITIONS REQUIRE A MANHOLE FRAME AND COVER TO BE INSTALLED WITHIN A PEDESTRIAN PATHWAY, THE MANHOLE FRAME AND COVER SHALL BE ADA COMPLIANT.
3. NON-ROCKING FIT FOR MANHOLE COVERS.
4. CASTING TO BE SHOT BLASTED AND FREE FROM SURFACE SAND AND SCALE.
5. CASTING TO BE SMOOTH, TRUE TO PATTERN, FREE FROM BLOWHOLES, POROSITY HARD SPOTS, SHRINK HOLES, WARP, OR ANY OTHER DEFECTS WHICH COULD IMPAIR SERVICEABILITY.
6. CASTINGS SHALL BE UNCOATED.
7. FOR STORM APPLICATIONS CAST LETTERS SHALL READ "STORM".
8. INSTALL FRAME AND COVER IN ROADWAY WITH HINGED SIDE OF ASSEMBLY POINTED TOWARD ONCOMING TRAFFIC.
9. THE CITY SHALL HAVE THE RIGHT TO REQUIRE INSPECTION AND APPROVAL OF ALL CASTINGS PRIOR TO PAINTING.
10. REPAIR OR DEFECTS BY WELDING, OR BY THE USE OF "SMOOTH-ON" OR SIMILAR MATERIAL WILL NOT BE PERMITTED.
11. MANHOLE RING AND COVER SHALL BE FREE OF POROSITY, SHRINK CAVITIES, COLD SHUTS OR CRACKS OR ANY SURFACE DEFECTS WHICH WOULD IMPAIR SERVICEABILITY.
*. FRAME HEIGHT MAY BE 4" FOR OVERLAYS AND PAVEMENT REHABILITATION PROJECTS, WITH WRITTEN APPROVAL BY THE CITY ENGINEER.

CITY OF PUYALLUP
OFFICE of THE CITY ENGINEER


APPROVED FOR PUBLICATION — DATE SIGNED: 2/15/2017

MANHOLE FRAME AND COVER

CITY STANDARD 06.01.02

DO NOT TO SCALE

FILE NAME: F:\DWG\PROJECTS\2020\21585\DWG\GD-1 Precast Traffic Curb\GD-1.dgn

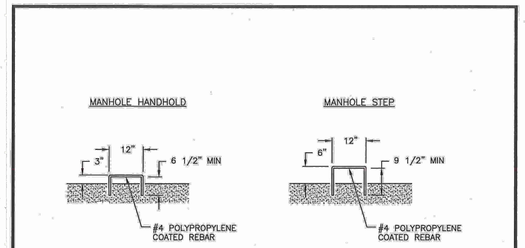

NOTES

1. MANHOLE STEPS AND HANDHOLDS SHALL BE POLYPROPYLENE COATED GRADE 60 REBAR CONFORMING TO ASTM C-478, D-4101, A-615 AND AASHTO M-199.
2. PREFABRICATED LADDERS SHALL BE MADE OF REBAR AND ENCASED IN POLYPROPYLENE AFTER FABRICATION.
3. STEPS MAY BE INSTALLED:
   CAST IN PLACE, OR
   DRIVEN INTO PREFORMED HOLES WITH THE CONCRETE CURED TO 3,000 PSI MINIMUM, OR
   BY DRILLING TWO ONE INCH DIAMETER HOLES, 3-3/4" DEEP, 13" O.C. APPLY NON-SHRINK GROUT AROUND BARBED ENDS AND DRIVE TO FULL INSERTION.
4. PENETRATION OF THE OUTER WALL OF A STRUCTURE WITH A LEG OF A STEP OR LADDER SHALL NOT OCCUR. STEPS AND LADDER RUNGS SHALL BE SPACED AT 12 INCHES AND SHALL BE VERTICALLY ALIGNED.
5. STEPS, HANDHOLDS, LADDER RUNGS AND FASTENINGS SHALL BE DESIGNED FOR A MINIMUM LIVE LOAD OF 300 LBS AND A PULL OUT FORCE OF 1,000 LBS.
6. STEPS, HANDHOLDS, AND LADDER PARTS SHALL BE FREE OF SPLINTERS, SHARP EDGES, BURRS OR PROJECTIONS WHICH MAY CAUSE HAZARDS.
7. REQUESTS TO USE STEPS, HANDHOLDS AND LADDERS MADE FROM NON-CORROSIVE MATERIALS SUCH AS STAINLESS STEEL AND PLASTIC MAY BE ACCEPTED AFTER REVIEW AND APPROVAL BY THE CITY. GALVANIZED STEEL WILL NOT BE PERMITTED IN SANITARY SEWER AND STORM SEWER MANHOLES AND STRUCTURES.


CITY OF PUYALLUP
OFFICE of THE CITY ENGINEER

MANHOLE STEP AND HANDHOLD

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	DATE REVISED	CITY STANDARD
JSM EWEN-SVOBODA	TED HILL	MARK PALMER	V STOCKSIAN	10/23/13	
FILE NAME: F:\DWG\COMMON\STD\CITY\STD9\06_MISC\06.01.03.01.03		DATE APPROVED: 03/01/2009	SCALE: NO SCALE	03/31/17 XX/XX/XX XX/XX/XX	06.01.03

ISSUE DATE: 3/16/17

NOTE
1. SCUPPERS TO BE PROVIDED AT INTERVALS AS REQUIRED BY THE ENGINEER

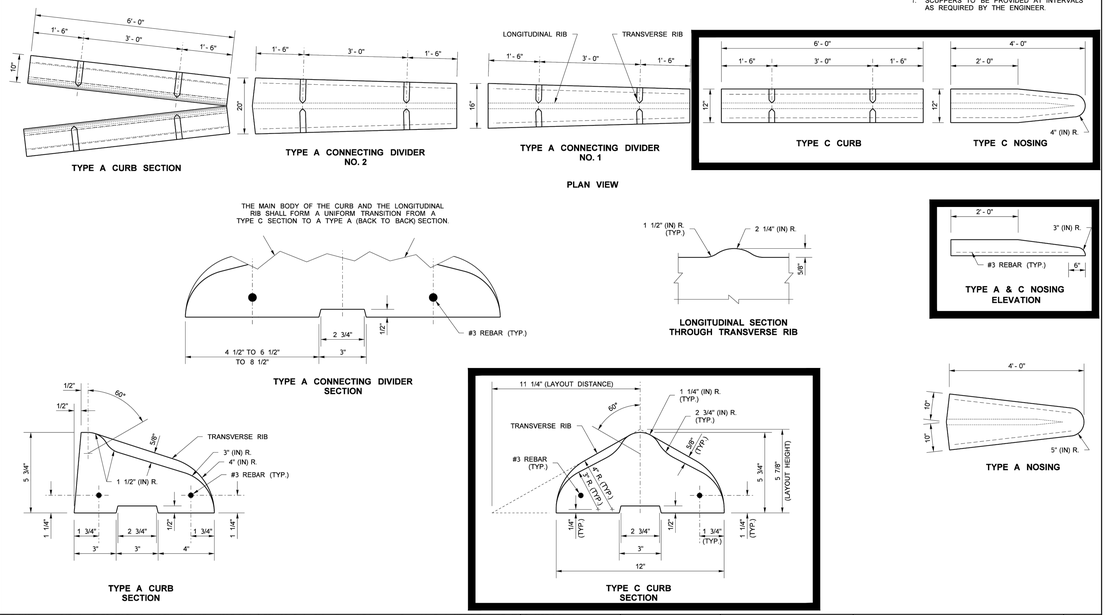

FILE NAME	S:\Design R P& S\4-Standards\2-Plan Sheet Library\01-Published PSL\(GD) Curbs, Sidewalks, and Driveways Geometric Design\(GD-1) Precast Traffic Curb\GD-1.dgn							Plot 1
TIME	1:48:19 PM				REGION NO.	STATE	FED.AID PROJ.NO.	PLAN REF NO. GD-1
DATE	10/6/2014					WASH		
PLOTTED BY	FletcCo				JOB NUMBER			SHEET 1 of 1 SHEETS
DESIGNED BY								
ENTERED BY								
CHECKED BY					CONTRACT NO.		LOCATION NO.	
PROJ. ENGR.								
REGIONAL ADM.		REVISION	DATE	BY				

Washington State Department of Transportation

P.E. STAMP BOX — DATE

PRECAST TRAFFIC CURB

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY CONSTRUCTION DETAILS** FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal N/A Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C41 of 48

P:\21000s\21585\engineering\SEPA SET\21585-D.dwg 6/3/2025 11:50 AM DCASEY

PRELIMINARY CONSTRUCTION DETAILS

OF

FREEMAN LOGISTICS


PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

WQ VAULT #1


SITE SPECIFIC DATA				
Structure ID				ID
Treatment Flow Rate (cfs)				0.143
Peak Flow Rate (cfs)				0.694
Rim Elevation				30.19
Top of Vault Elevation				22.12
Pipe Data	**Pipe Location**	**Pipe Size**	**Pipe Type**	**Invert Elevation**
Inlet	N	18"	CPEP	20.29
Outlet	S	18"	CPEP	18.12
Notes:				

PERFORMANCE SPECIFICATIONS	
Treatment Flow Capacities:*	
NJDEP 80% Removal, 75 micron	0.240 cfs
WA Ecology GULD - Basic, Enhanced & Phosphorus	0.213 cfs
Bypass Capacity	5.0 cfs

*Contact Oldcastle for alternative treatment flow capacities.

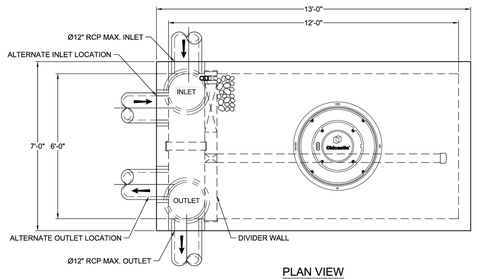

PLAN VIEW

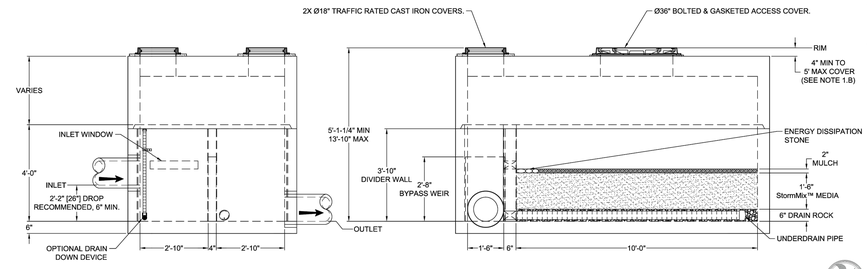

LEFT END VIEW ELEVATION VIEW

NOTES:

1. DESIGN LOADINGS:
   A. AASHTO HS-20-44 (WITH IMPACT)
   B. DESIGN SOIL COVER: 5'-0" MAXIMUM
   C. ASSUMED WATER TABLE: BELOW BASE OF PRECAST (ENGINEER-OF-RECORD TO CONFIRM SITE WATER TABLE ELEVATION)
   D. LATERAL EARTH PRESSURE: 45 PCF (DRAINED)
   E. LATERAL LIVE LOAD SURCHARGE: 80 PSF (APPLIED TO 8'-0" BELOW GRADE)
   F. NO LATERAL SURCHARGE FROM ADJACENT BUILDINGS, WALLS, PIERS, OR FOUNDATIONS.
2. CONCRETE 28-DAY MINIMUM COMPRESSIVE STRENGTH: 5,000 PSI MINIMUM.
3. REINFORCING: REBAR, ASTM A615/A706, GRADE 60
4. CEMENT: ASTM C150
5. REQUIRED ALLOWABLE SOIL BEARING CAPACITY: 2,500 PSF
6. REFERENCE STANDARD:
   A. ASTM C890
   B. ASTM C913
   C. ACI 318-14
7. THIS STRUCTURE IS DESIGNED TO THE PARAMETERS NOTED HEREIN. ENGINEER-OF-RECORD SHALL VERIFY FY THAT NOTED PARAMETERS MEET OR EXCEED PROJECT REQUIREMENTS. IF DESIGN PARAMETERS ARE INCORRECT, REVIEWING ENGINEER/AUTHORITY SHALL NOTIFY OLDCASTLE INFRASTRUCTURE UPON REVIEW.
8. INLET AND OUTLET HOLES WILL BE FACTORY CORED/CAST PER PLANS AND CUSTOMER REQUIREMENTS. INLET AND OUTLET LOCATIONS CAN BE MIRRORED.
9. CONTRACTOR RESPONSIBLE TO VERIFY ALL SIZES, LOCATIONS, AND ELEVATIONS OF OPENINGS.
10. CONTRACTOR RESPONSIBLE TO ENSURE ADEQUATE BEARING SURFACE IS PROVIDED (I.E. COMPACTED AND LEVEL PER PROJECT SPECIFICATIONS).
11. SECTION HEIGHTS, SLABWALL THICKNESSES, AND KEYWAYS ARE SUBJECT TO CHANGE AS REQUIRED FOR SITE REQUIREMENTS AND/OR DUE TO PRODUCT AVAILABILITY AND PRODUCTION FACILITY CONSTRAINTS.
12. MAXIMUM PICK WEIGHTS*:
    A. TOP: XX,XXX LBS
    B. BASE: XX,XXX LBS*
       (* COMBINED WEIGHT OF BASE INCLUDES BYPASS WEIR, DIVIDER WALL, ROCK & MEDIA)
13. INTERNALS SHALL CONSIST OF UNDERDRAIN PIPE, ROCK, STORMMIX™ MEDIA, MULCH, DIVIDER WALL, BYPASS WEIR AND OPTIONAL DRAIN DOWN.

Oldcastle Infrastructure
A CRH COMPANY

Ph: 800.579.8512 | www.oldcastleinfrastructure.com/stormwater

THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE INFRASTRUCTURE, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR IN COMPETITION WITH OLDCASTLE INFRASTRUCTURE, INC. ALL RIGHTS RESERVED
COPYRIGHT © 2022 OLDCASTLE INFRASTRUCTURE, INC. ALL RIGHTS RESERVED

BioPod™ Biofilter System (STANDARD)

6' x 12' Underground with Internal Bypass

CUSTOMER: -

PROJECT NAME: -

SHEET NAME	REVISION	SHEET
Specifier Drawing BPU-612B	-	1 OF 1
	REV DATE	


Bioretention/ Biofiltration

WQ VAULT #2


SITE SPECIFIC DATA				
Structure ID				ID
Treatment Flow Rate (cfs)				0.149
Peak Flow Rate (cfs)				0.750
Rim Elevation				31.50
Top of Vault Elevation				22.90
Pipe Data	**Pipe Location**	**Pipe Size**	**Pipe Type**	**Invert Elevation**
Inlet	S	18"	CPEP	21.07
Outlet	N	18"	CPEP	18.90
Notes:				

PERFORMANCE SPECIFICATIONS	
Treatment Flow Capacities:*	
NJDEP 80% Removal, 75 micron	0.240 cfs
WA Ecology GULD - Basic, Enhanced & Phosphorus	0.213 cfs
Bypass Capacity	5.0 cfs

*Contact Oldcastle for alternative treatment flow capacities.

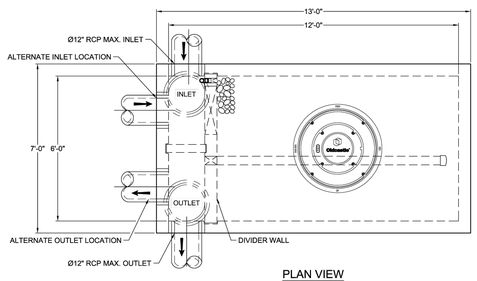

PLAN VIEW

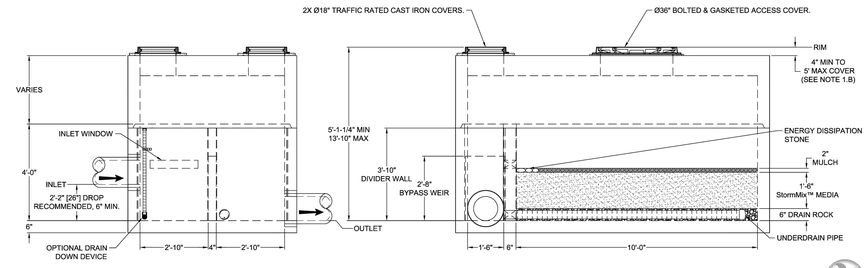

LEFT END VIEW ELEVATION VIEW

NOTES:

1. DESIGN LOADINGS:
   A. AASHTO HS-20-44 (WITH IMPACT)
   B. DESIGN SOIL COVER: 5'-0" MAXIMUM
   C. ASSUMED WATER TABLE: BELOW BASE OF PRECAST (ENGINEER-OF-RECORD TO CONFIRM SITE WATER TABLE ELEVATION)
   D. LATERAL EARTH PRESSURE: 45 PCF (DRAINED)
   E. LATERAL LIVE LOAD SURCHARGE: 80 PSF (APPLIED TO 8'-0" BELOW GRADE)
   F. NO LATERAL SURCHARGE FROM ADJACENT BUILDINGS, WALLS, PIERS, OR FOUNDATIONS.
2. CONCRETE 28-DAY MINIMUM COMPRESSIVE STRENGTH: 5,000 PSI MINIMUM.
3. REINFORCING: REBAR, ASTM A615/A706, GRADE 60
4. CEMENT: ASTM C150
5. REQUIRED ALLOWABLE SOIL BEARING CAPACITY: 2,500 PSF
6. REFERENCE STANDARD:
   A. ASTM C890
   B. ASTM C913
   C. ACI 318-14
7. THIS STRUCTURE IS DESIGNED TO THE PARAMETERS NOTED HEREIN. ENGINEER-OF-RECORD SHALL VERIFY FY THAT NOTED PARAMETERS MEET OR EXCEED PROJECT REQUIREMENTS. IF DESIGN PARAMETERS ARE INCORRECT, REVIEWING ENGINEER/AUTHORITY SHALL NOTIFY OLDCASTLE INFRASTRUCTURE UPON REVIEW.
8. INLET AND OUTLET HOLES WILL BE FACTORY CORED/CAST PER PLANS AND CUSTOMER REQUIREMENTS. INLET AND OUTLET LOCATIONS CAN BE MIRRORED.
9. CONTRACTOR RESPONSIBLE TO VERIFY ALL SIZES, LOCATIONS, AND ELEVATIONS OF OPENINGS.
10. CONTRACTOR RESPONSIBLE TO ENSURE ADEQUATE BEARING SURFACE IS PROVIDED (I.E. COMPACTED AND LEVEL PER PROJECT SPECIFICATIONS).
11. SECTION HEIGHTS, SLABWALL THICKNESSES, AND KEYWAYS ARE SUBJECT TO CHANGE AS REQUIRED FOR SITE REQUIREMENTS AND/OR DUE TO PRODUCT AVAILABILITY AND PRODUCTION FACILITY CONSTRAINTS.
12. MAXIMUM PICK WEIGHTS*:
    A. TOP: XX,XXX LBS
    B. BASE: XX,XXX LBS*
       (* COMBINED WEIGHT OF BASE INCLUDES BYPASS WEIR, DIVIDER WALL, ROCK & MEDIA)
13. INTERNALS SHALL CONSIST OF UNDERDRAIN PIPE, ROCK, STORMMIX™ MEDIA, MULCH, DIVIDER WALL, BYPASS WEIR AND OPTIONAL DRAIN DOWN.

Oldcastle Infrastructure
A CRH COMPANY

Ph: 800.579.8512 | www.oldcastleinfrastructure.com/stormwater

THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE INFRASTRUCTURE, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR IN COMPETITION WITH OLDCASTLE INFRASTRUCTURE, INC. ALL RIGHTS RESERVED
COPYRIGHT © 2022 OLDCASTLE INFRASTRUCTURE, INC. ALL RIGHTS RESERVED

BioPod™ Biofilter System (STANDARD)

6' x 12' Underground with Internal Bypass

CUSTOMER: -

PROJECT NAME: -

SHEET NAME	REVISION	SHEET
Specifier Drawing BPU-612B	-	1 OF 1
	REV DATE	


Bioretention/ Biofiltration

WQ VAULT #1R


SITE SPECIFIC DATA				
Structure ID				ID
Treatment Flow Rate (cfs)				0.033
Peak Flow Rate (cfs)				0.252
Rim Elevation				33.98
Top of Vault Elevation				19.82
Pipe Data	**Pipe Location**	**Pipe Size**	**Pipe Type**	**Invert Elevation**
Inlet	E	12"	CPEP	17.99
Outlet	W	12"	CPEP	15.82
Notes:				

PERFORMANCE SPECIFICATIONS	
Treatment Flow Capacities:*	
NJDEP 80% Removal, 75 micron	0.064 cfs
WA Ecology GULD - Basic, Enhanced & Phosphorus	0.057 cfs
Bypass Capacity	5.0 cfs

*Contact Oldcastle for alternative treatment flow capacities.

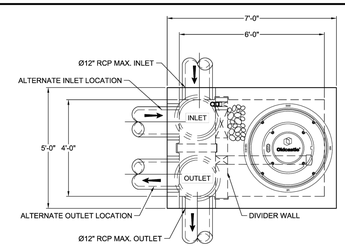

PLAN VIEW

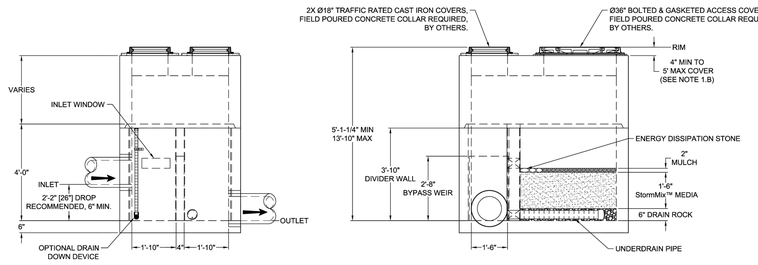

LEFT END VIEW ELEVATION VIEW

NOTES:

1. DESIGN LOADINGS:
   A. AASHTO HS-20-44 (WITH IMPACT)
   B. DESIGN SOIL COVER: 5'-0" MAXIMUM
   C. ASSUMED WATER TABLE: BELOW BASE OF PRECAST (ENGINEER-OF-RECORD TO CONFIRM SITE WATER TABLE ELEVATION)
   D. LATERAL EARTH PRESSURE: 45 PCF (DRAINED)
   E. LATERAL LIVE LOAD SURCHARGE: 80 PSF (APPLIED TO 8'-0" BELOW GRADE)
   F. NO LATERAL SURCHARGE FROM ADJACENT BUILDINGS, WALLS, PIERS, OR FOUNDATIONS.
2. CONCRETE 28-DAY MINIMUM COMPRESSIVE STRENGTH: 5,000 PSI MINIMUM.
3. REINFORCING: REBAR, ASTM A615/A706, GRADE 60
4. CEMENT: ASTM C150
5. REQUIRED ALLOWABLE SOIL BEARING CAPACITY: 2,500 PSF
6. REFERENCE STANDARD:
   A. ASTM C890
   B. ASTM C913
   C. ACI 318-14
7. THIS STRUCTURE IS DESIGNED TO THE PARAMETERS NOTED HEREIN. ENGINEER-OF-RECORD SHALL VERIFY FY THAT NOTED PARAMETERS MEET OR EXCEED PROJECT REQUIREMENTS. IF DESIGN PARAMETERS ARE INCORRECT, REVIEWING ENGINEER/AUTHORITY SHALL NOTIFY OLDCASTLE INFRASTRUCTURE UPON REVIEW.
8. INLET AND OUTLET HOLES WILL BE FACTORY CORED/CAST PER PLANS AND CUSTOMER REQUIREMENTS. INLET AND OUTLET LOCATIONS CAN BE MIRRORED.
9. CONTRACTOR RESPONSIBLE TO VERIFY ALL SIZES, LOCATIONS, AND ELEVATIONS OF OPENINGS.
10. CONTRACTOR RESPONSIBLE TO ENSURE ADEQUATE BEARING SURFACE IS PROVIDED (I.E. COMPACTED AND LEVEL PER PROJECT SPECIFICATIONS).
11. SECTION HEIGHTS, SLABWALL THICKNESSES, AND KEYWAYS ARE SUBJECT TO CHANGE AS REQUIRED FOR SITE REQUIREMENTS AND/OR DUE TO PRODUCT AVAILABILITY AND PRODUCTION FACILITY CONSTRAINTS.
12. MAXIMUM PICK WEIGHTS*:
    A. TOP: XX,XXX LBS
    B. BASE: XX,XXX LBS*
       (* COMBINED WEIGHT OF BASE INCLUDES BYPASS WEIR, DIVIDER WALL, ROCK & MEDIA)
13. INTERNALS SHALL CONSIST OF UNDERDRAIN PIPE, ROCK, STORMMIX™ MEDIA, MULCH, DIVIDER WALL, BYPASS WEIR AND OPTIONAL DRAIN DOWN.

Oldcastle Infrastructure
A CRH COMPANY

Ph: 800.579.8512 | www.oldcastleinfrastructure.com/stormwater

THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE INFRASTRUCTURE, INC. IT IS CONFIDENTIAL, SUBMITTED FOR REFERENCE PURPOSES ONLY AND SHALL NOT BE USED IN ANY WAY INJURIOUS TO THE INTERESTS OF, OR IN COMPETITION WITH OLDCASTLE INFRASTRUCTURE, INC. ALL RIGHTS RESERVED
COPYRIGHT © 2022 OLDCASTLE INFRASTRUCTURE, INC. ALL RIGHTS RESERVED

BioPod™ Biofilter System (STANDARD)

Underground Vault with Internal Bypass

CUSTOMER: -

PROJECT NAME: -

SHEET NAME	REVISION	SHEET
Specifier Drawing BPU-48B	-	1 OF 1
	REV DATE	

Bioretention/ Biofiltration

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title:
PRELIMINARY CONSTRUCTION DETAILS
FOR
FREEMAN LOGISTICS

For:
VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARTHUR — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal N/A Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C42 of 48


P:\21000s\21585\engineering\SEPA SET\21585-D.dwg 6/3/2025 11:50 AM DCASEY

PRELIMINARY STORM PUMP DETAILS

OF


FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

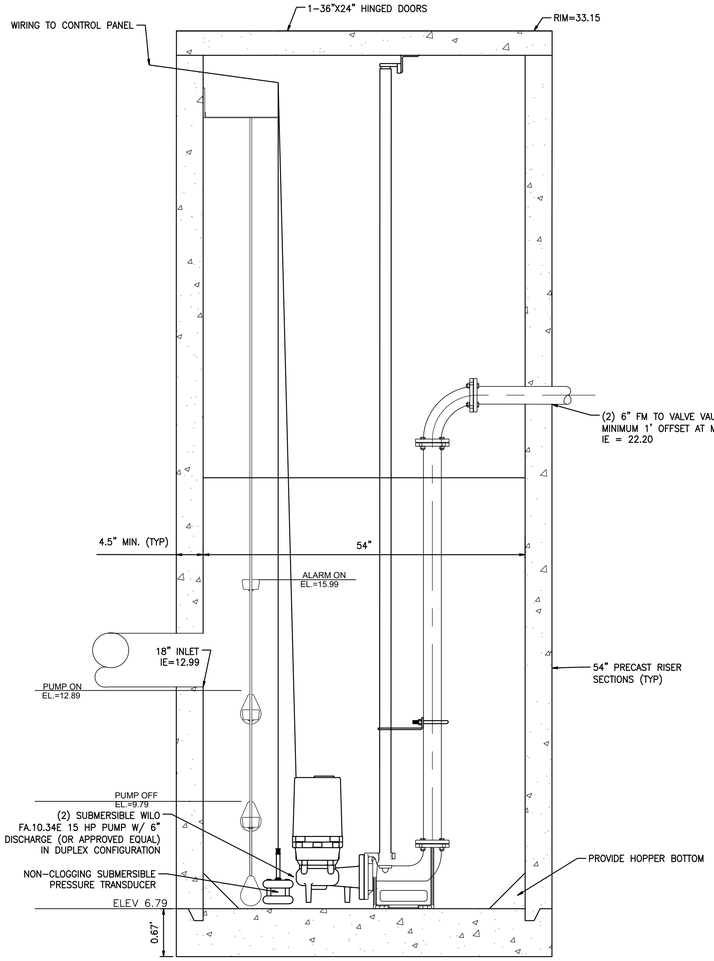


STORM PUMP MANHOLE DETAIL


SCALE: HOR. 1"=2' VER. 1"=1'

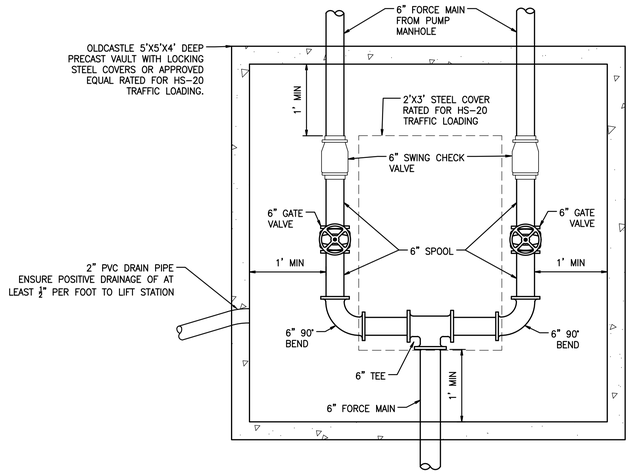

STORM VALVE VAULT DETAIL

SCALE: NTS

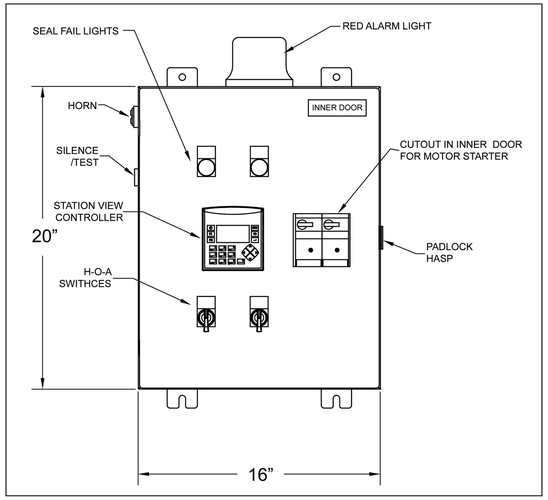

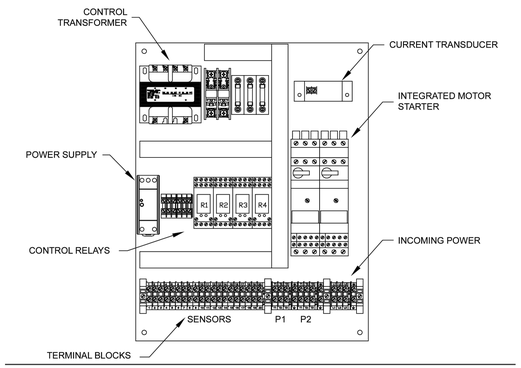

EXAMPLE THREE PHASE DUPLEX LIFT STATION CONTROL PANEL

SCALE: NTS

NOTES:


1. EMERGENCY BACKUP GENERATOR TO BE PROVIDED BY CONTRACTOR. SIZING TO BE DETERMINED BASED ON FINAL PUMP SELECTION. GENERATOR TO BE SIZED TO ACCOMMODATE BOTH PUMPS OPERATING. CONTROL PANEL TO BE EQUIPPED WITH AUTOMATIC TRANSFER SWITCH. SEE SITE PLAN FOR SUGGESTED GENERATOR LOCATION.
2. CONTROL PANEL TO BE EQUIPPED WITH VARIABLE FREQUENCY DRIVES (VFD) FOR BOTH PUMPS.

Wilo Quick Ship
Equipment Submittal

wilo®

FA 10.34E – 4 pole, 1740 RPM, Non-clog Vane Type



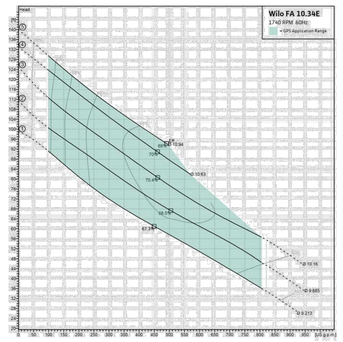

GERMAN QUALITY since 1872

Installation Type	
Installation Type	Wet Pit
	Dry Pit
Voltage	230v
	460v
Suction Size	4"
Discharge Size	4"

Impeller Number	Impeller Diameter		Motor HP
	in	mm	
1	9.213	234	15.5
2	9.685	246	15.5
3	10.16	258	25
4	10.63	270	25
5	10.94	278	25

Materials of Construction	
Volute	ASTM A48 Class 35 Cast Iron
Impeller	ASTM A48 Class 35 Cast Iron
Volute Wear Ring	AISI 304 Stainless Steel
Impeller Wear Ring	AISI 329 Duplex Stainless Steel

WILO USA LLC
86 Genesis Parkway
Thomasville, GA 31792

T + 888-945-6872
F + 888-945-6873
www.wilo-usa.com

STORM PUMP CURVE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY STORM PUMP DETAILS**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MORRIS — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal AS SHOWN Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C43 of 48

P:\21000s\21585\engineering\SEPA SET\21585-D.dwg 6/3/2025 11:50 AM DCASEY


PRELIMINARY TRUCK TURN EXHIBIT NORTH ACCESS

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

0 15' 30' 60'
SCALE: 1"=30'

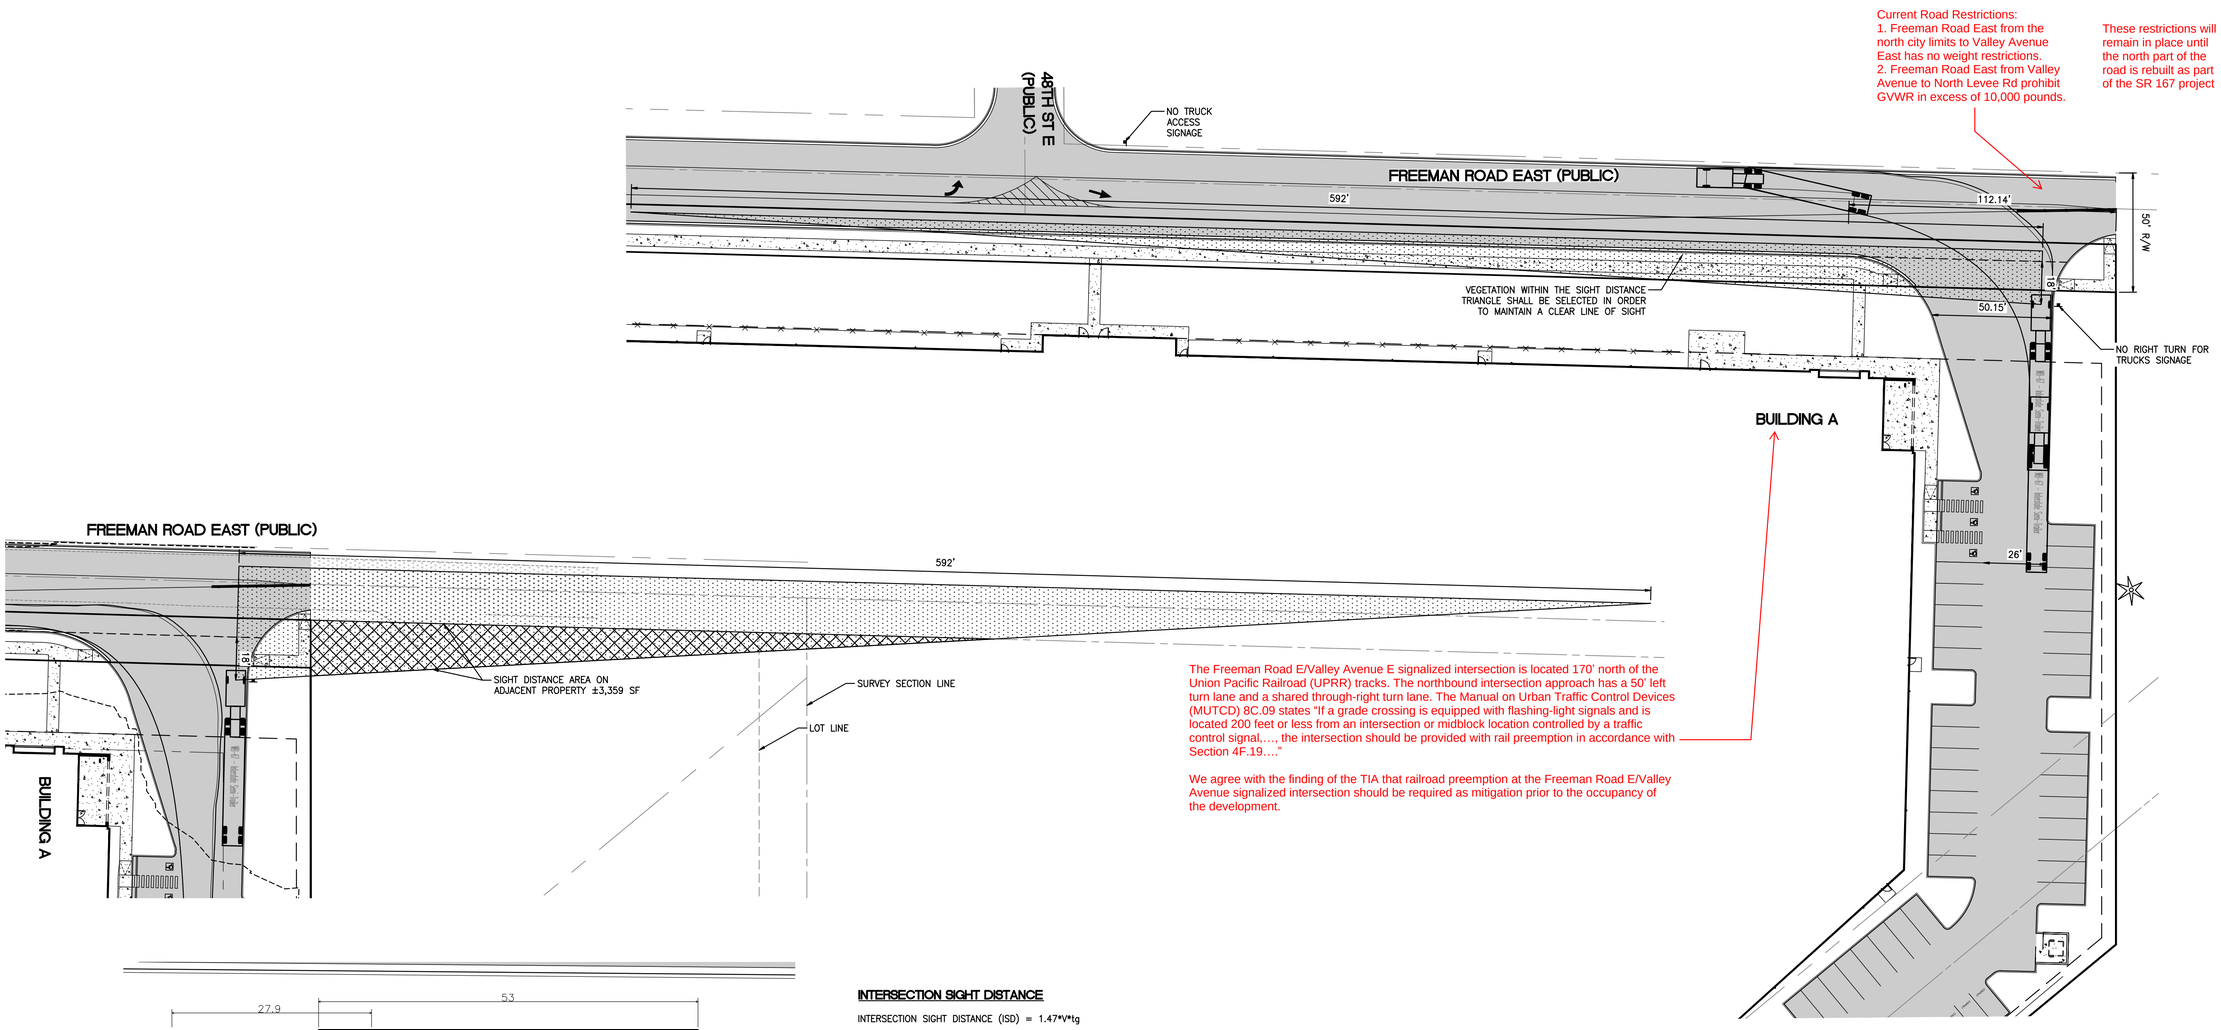


Current Road Restrictions:
1. Freeman Road East from the north city limits to Valley Avenue East has no weight restrictions.
2. Freeman Road East from Valley Avenue to North Levee Rd prohibit GVWR in excess of 10,000 pounds.

These restrictions will remain in place until the north part of the road is rebuilt as part of the SR 167 project

The Freeman Road E/Valley Avenue E signalized intersection is located 170' north of the Union Pacific Railroad (UPRR) tracks. The northbound intersection approach has a 50' left turn lane and a shared through-right turn lane. The Manual on Urban Traffic Control Devices (MUTCD) 8C.09 states "If a grade crossing is equipped with flashing-light signals and is located 200 feet or less from an intersection or midblock location controlled by a traffic control signal,..., the intersection should be provided with rail preemption in accordance with Section 4F.19...."

We agree with the finding of the TIA that railroad preemption at the Freeman Road E/Valley Avenue signalized intersection should be required as mitigation prior to the occupancy of the development.

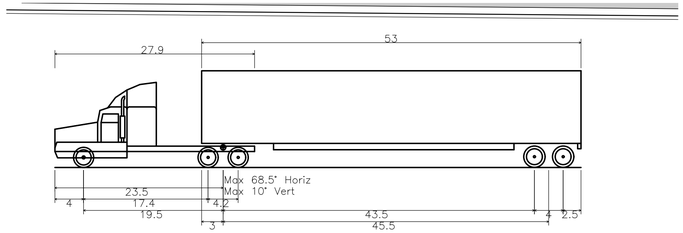

WB-67 - Interstate Semi-Trailer	
Overall Length	73.501ft
Overall Width	8.500ft
Overall Body Height	13.500ft
Min Body Ground Clearance	1.334ft
Max Track Width	8.500ft
Lock-to-lock time	6.00s
Max Steering Angle (Virtual)	28.40°

INTERSECTION SIGHT DISTANCE

INTERSECTION SIGHT DISTANCE (ISD) = 1.47*V*tg

WHERE V = DESIGN SPEED (MPH)
SITE POSTED AS 25 MPH ZONE, USE 35 MPH FOR DESIGN SPEED
tg = TIME GAP FOR THE PARTICULAR SCENARIO (TYPE OF MANEUVER AND VEHICLE)

tg = 6.5 SECONDS FOR PASSENGER VEHICLE TURNING RIGHT
tg = 7.5 SECONDS FOR PASSENGER VEHICLE TURNING LEFT
tg = 10.5 SECONDS FOR COMBINATION TRUCK VEHICLE TURNING RIGHT
tg = 11.5 SECONDS FOR COMBINATION TRUCK VEHICLE TURNING LEFT
PER AASHTO GREEN BOOK EDITION 7

STOPPING SIGHT DISTANCE

STOPPING SIGHT DISTANCE (SSD) = 1.47*V*tb + V^2/30[(a/32.2)+G]

WHERE V = DESIGN SPEED (MPH)
SITE POSTED AS 25 MPH ZONE, USE 35 MPH FOR DESIGN SPEED
tb = BRAKE REACTION TIME, EQUAL TO 2.5 SECONDS
PER AASHTO GREEN BOOK EDITION 7

a = DECELERATION, RECOMMENDED VALUE 11.2 FT/S^2
G = GRADE, RISE/RUN (FT/FT)

FOR A LEVEL APPROACH, WITH DESIGN SPEED EQUAL TO 35 MPH, SSD = 250'

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY TRUCK TURN EXHIBIT NORTH ACCESS** FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MARDE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=30' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C44 of 48

P:\21000s\21585\engineering\SEPA SET\21585-TT.dwg 7/16/2025 10:52 AM DCASEY

PRELIMINARY TRUCK TURN EXHIBIT SOUTH ACCESS


OF

FREEMAN LOGISTICS


PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 15' 30' 60'
SCALE: 1"=30'

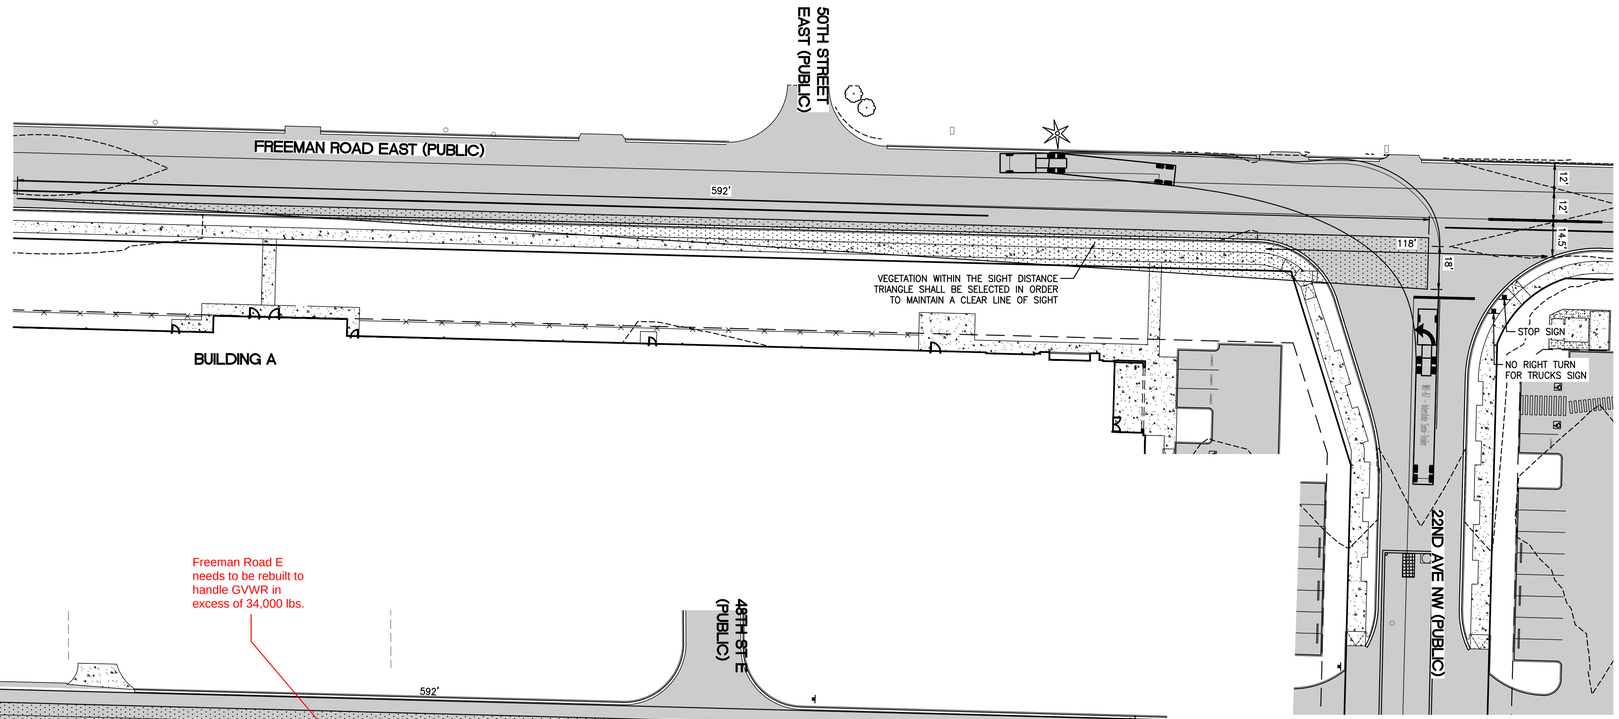

Freeman Road E needs to be rebuilt to handle GVWR in excess of 34,000 lbs.

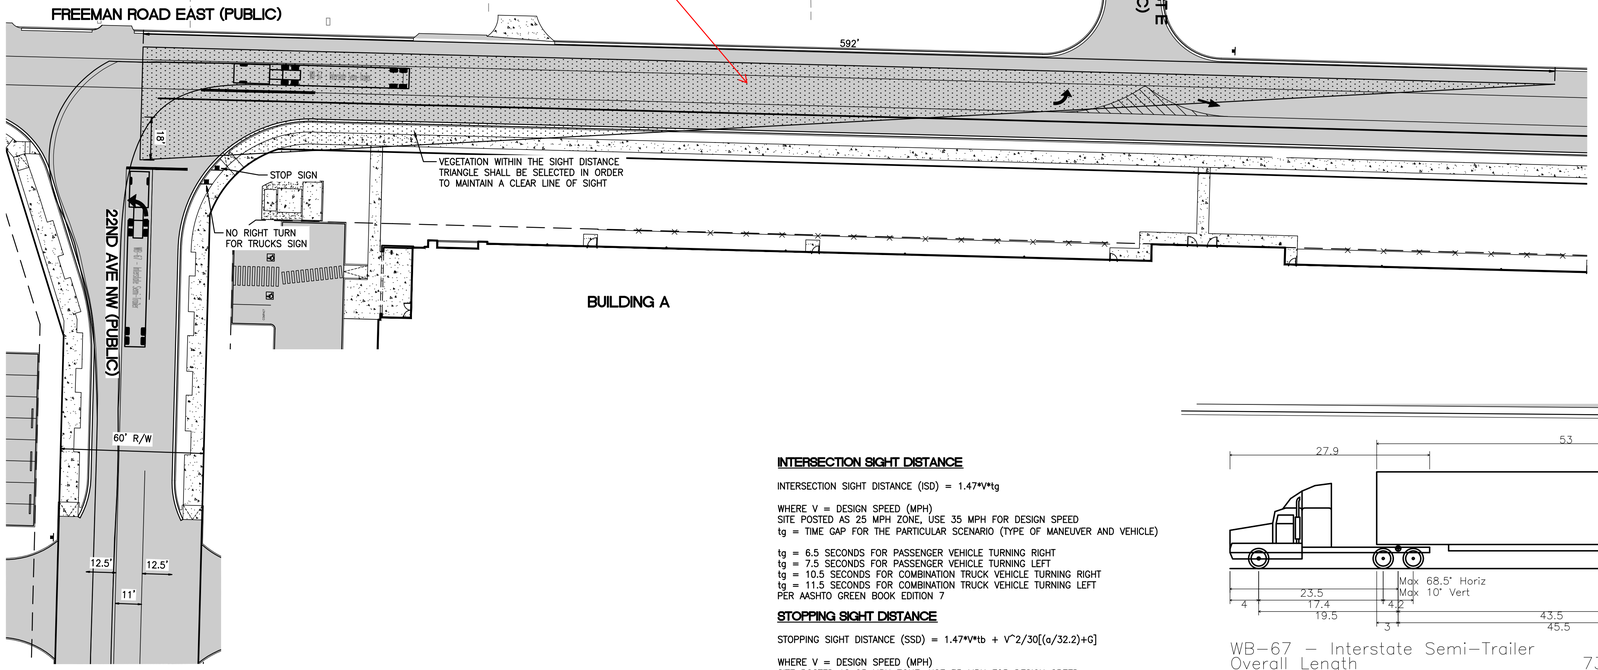

INTERSECTION SIGHT DISTANCE

INTERSECTION SIGHT DISTANCE (ISD) = 1.47*V*tg

WHERE V = DESIGN SPEED (MPH)
SITE POSTED AS 25 MPH ZONE, USE 35 MPH FOR DESIGN SPEED
tg = TIME GAP FOR THE PARTICULAR SCENARIO (TYPE OF MANEUVER AND VEHICLE)

tg = 6.5 SECONDS FOR PASSENGER VEHICLE TURNING RIGHT
tg = 7.5 SECONDS FOR PASSENGER VEHICLE TURNING LEFT
tg = 10.5 SECONDS FOR COMBINATION TRUCK VEHICLE TURNING RIGHT
tg = 11.5 SECONDS FOR COMBINATION TRUCK VEHICLE TURNING LEFT
PER AASHTO GREEN BOOK EDITION 7


STOPPING SIGHT DISTANCE

STOPPING SIGHT DISTANCE (SSD) = 1.47*V*tb + V^2/30[(a/32.2)+G]

WHERE V = DESIGN SPEED (MPH)
SITE POSTED AS 25 MPH ZONE, USE 35 MPH FOR DESIGN SPEED
tb = BRAKE REACTION TIME, EQUAL TO 2.5 SECONDS
PER AASHTO GREEN BOOK EDITION 7

a = DECELERATION, RECOMMENDED VALUE 11.2 FT/S^2
G = GRADE, RISE/RUN (FT/FT)

FOR A LEVEL APPROACH, WITH DESIGN SPEED EQUAL TO 35 MPH, SSD = 250'

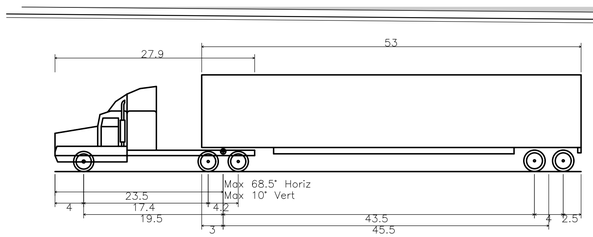

WB-67 – Interstate Semi-Trailer	
Overall Length	73.501ft
Overall Width	8.500ft
Overall Body Height	13.500ft
Min Body Ground Clearance	1.334ft
Max Track Width	8.500ft
Lock-to-lock time	6.00s
Max Steering Angle (Virtual)	28.40°

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	7/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY TRUCK TURN EXHIBIT SOUTH ACCESS** FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCCASEY — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=30' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C45 of 48


P:\21000s\21585\engineering\SEPA SET\21585-TT.dwg 7/16/2025 10:52 AM DCASEY


PRELIMINARY TRUCK TURN EXHIBIT FREEMAN & LEVEE

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

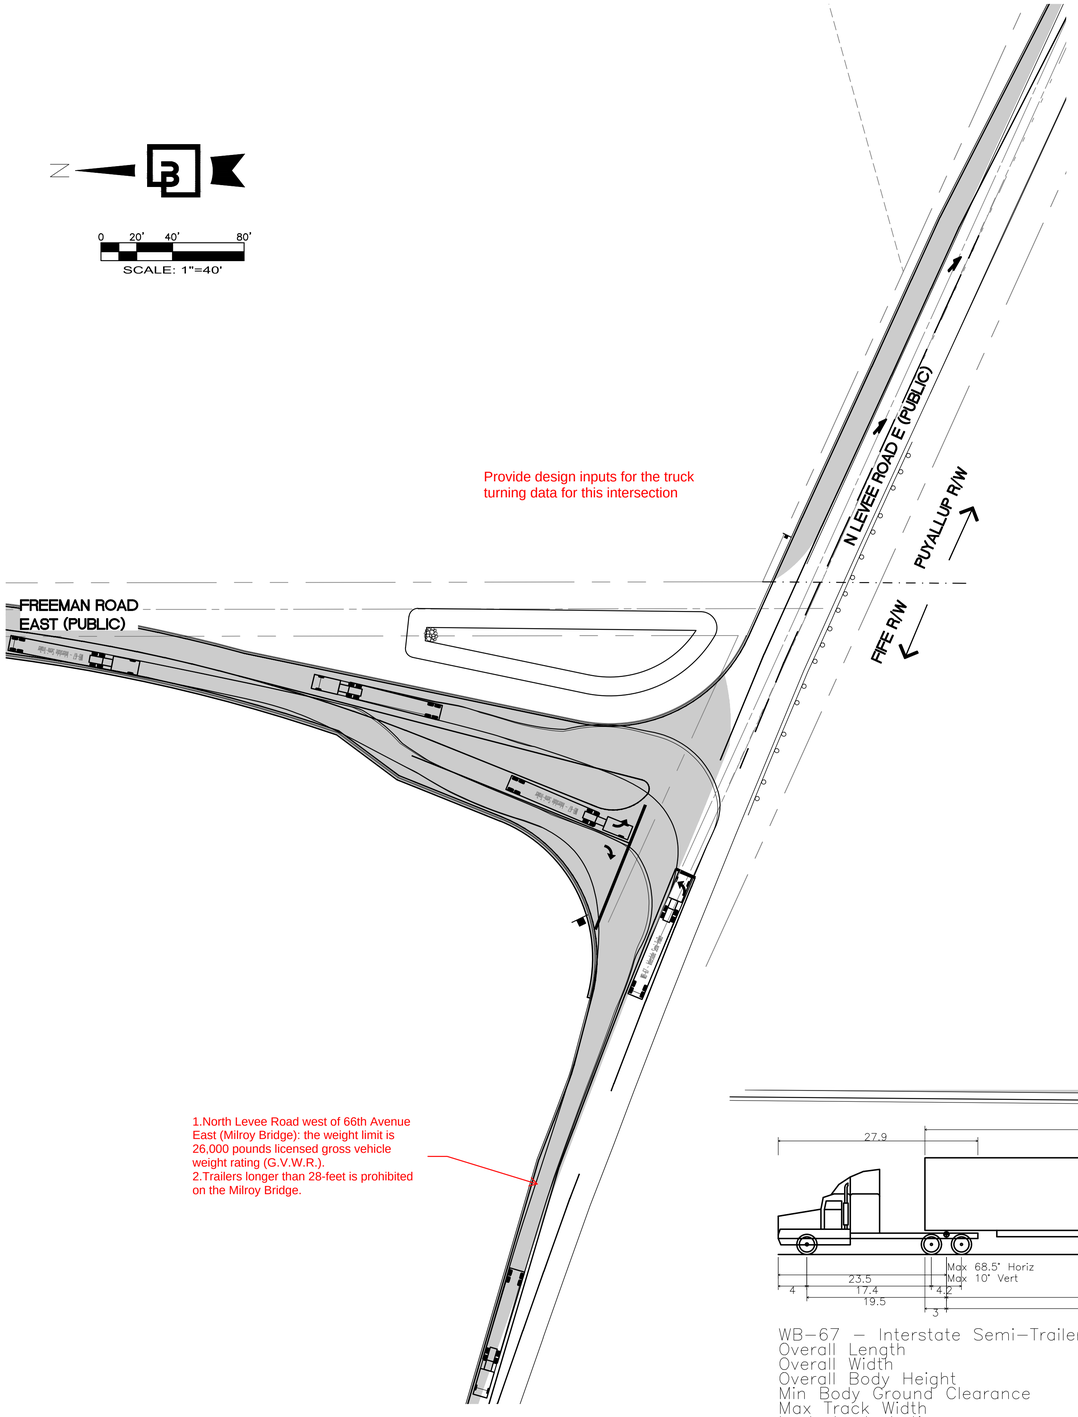

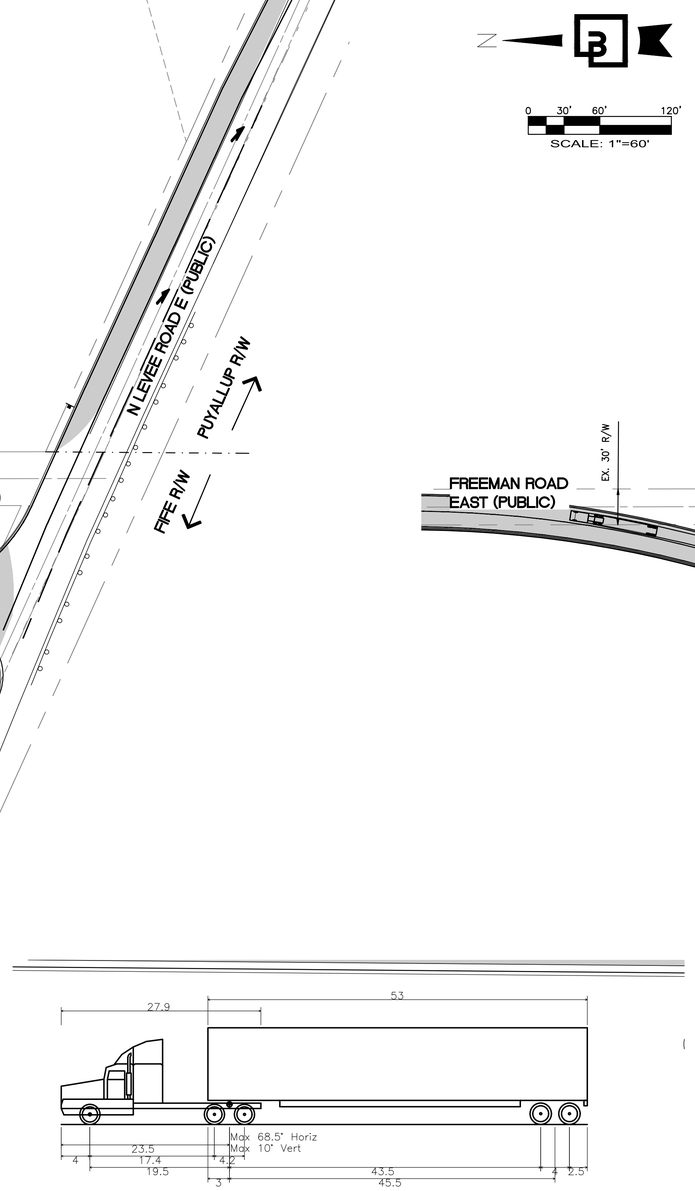

WB–67 – Interstate Semi–Trailer	
Overall Length	73.501ft
Overall Width	8.500ft
Overall Body Height	13.500ft
Min Body Ground Clearance	1.334ft
Max Track Width	8.500ft
Lock–to–lock time	6.00s
Max Steering Angle (Virtual)	28.40°

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title:
PRELIMINARY TRUCK TURN EXHIBIT FREEMAN & LEVEE
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal AS SHOWN Vertical N/A

Designed JSM
Drawn DTC
Checked JSM
Approved JSM
Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Job Number 21585

Sheet C46 of 48

P:\21000s\21585\engineering\SEPA SET\21585-TT.dwg 7/16/2025 10:52 AM DCASEY

PRELIMINARY SITE CIRCULATION EXHIBIT - NORTH


OF

FREEMAN LOGISTICS


PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N


0 25' 50' 100'
SCALE: 1"=50'

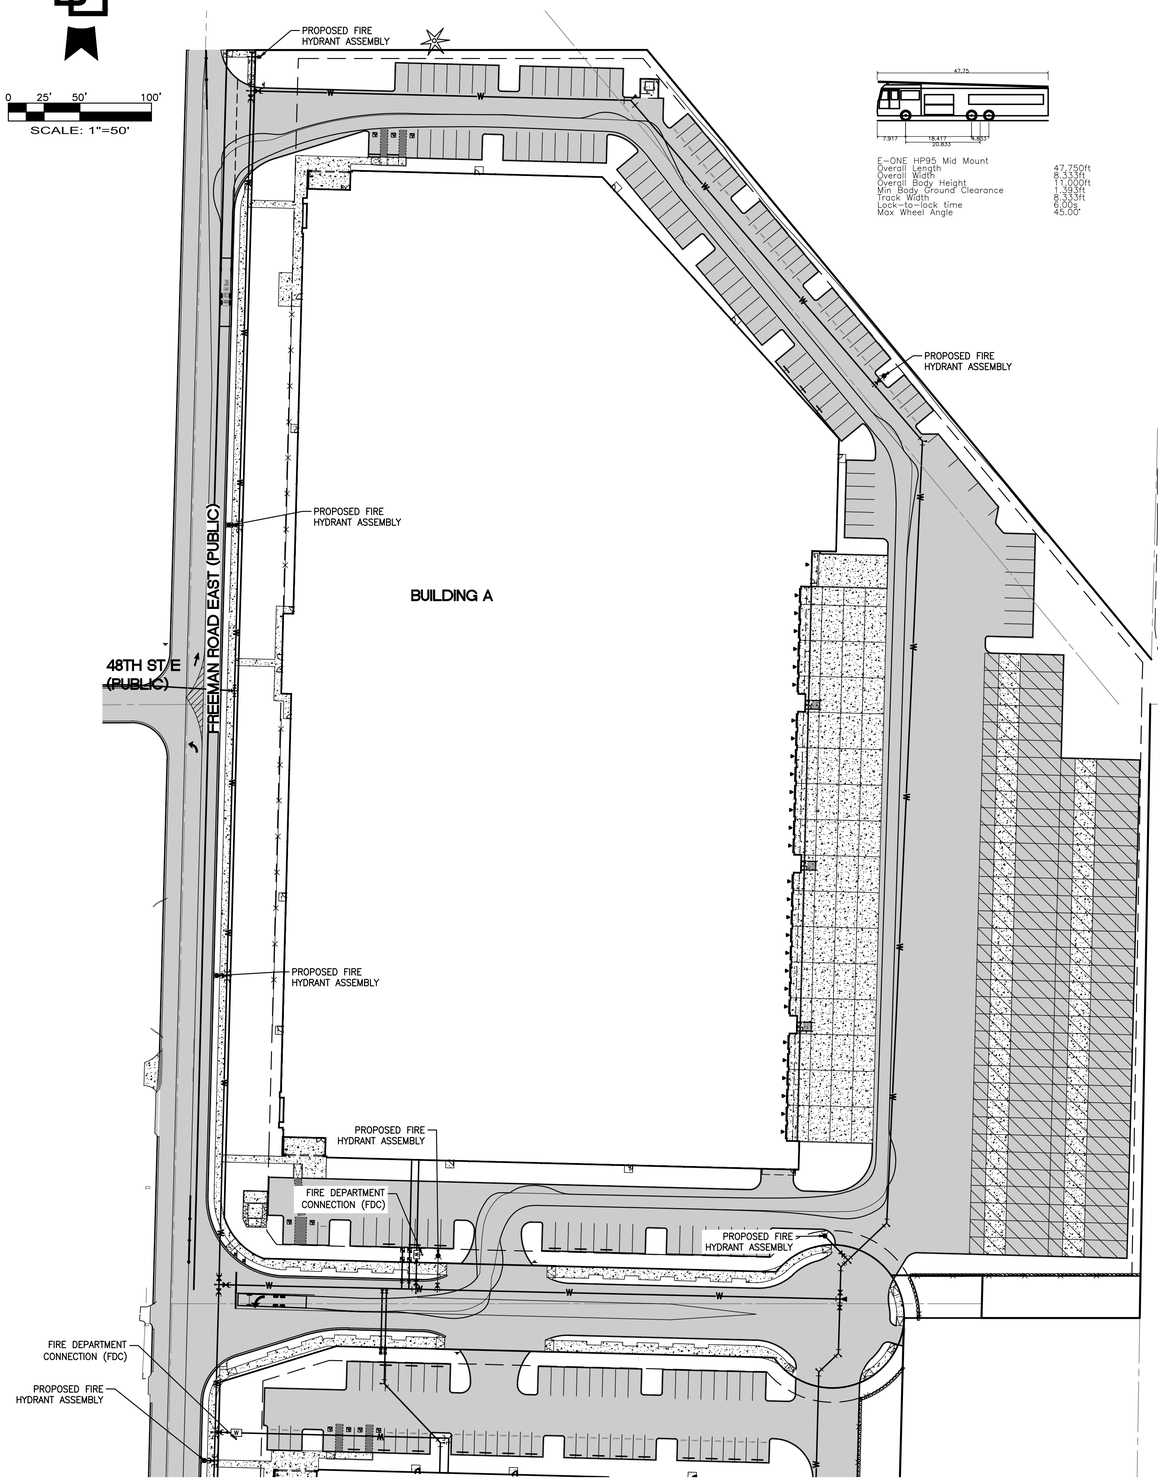

F-ONE HP95 Mid Mount	
Overall Length	47.750ft
Overall Width	8.333ft
Overall Body Height	11.000ft
Min Body Ground Clearance	1.333ft
Track Width	8.333ft
Lock-to-lock time	6.00s
Max Wheel Angle	45.00°

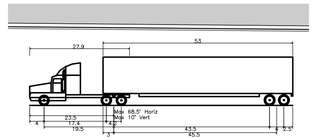

WB-67 – Interstate Semi-Trailer	
Overall Length	73.501ft
Overall Width	8.500ft
Overall Body Height	13.120ft
Min Body Ground Clearance	1.334ft
Max Track Width	8.500ft
Lock-to-lock time	6.00s
Max Steering Angle (Virtual)	28.40°

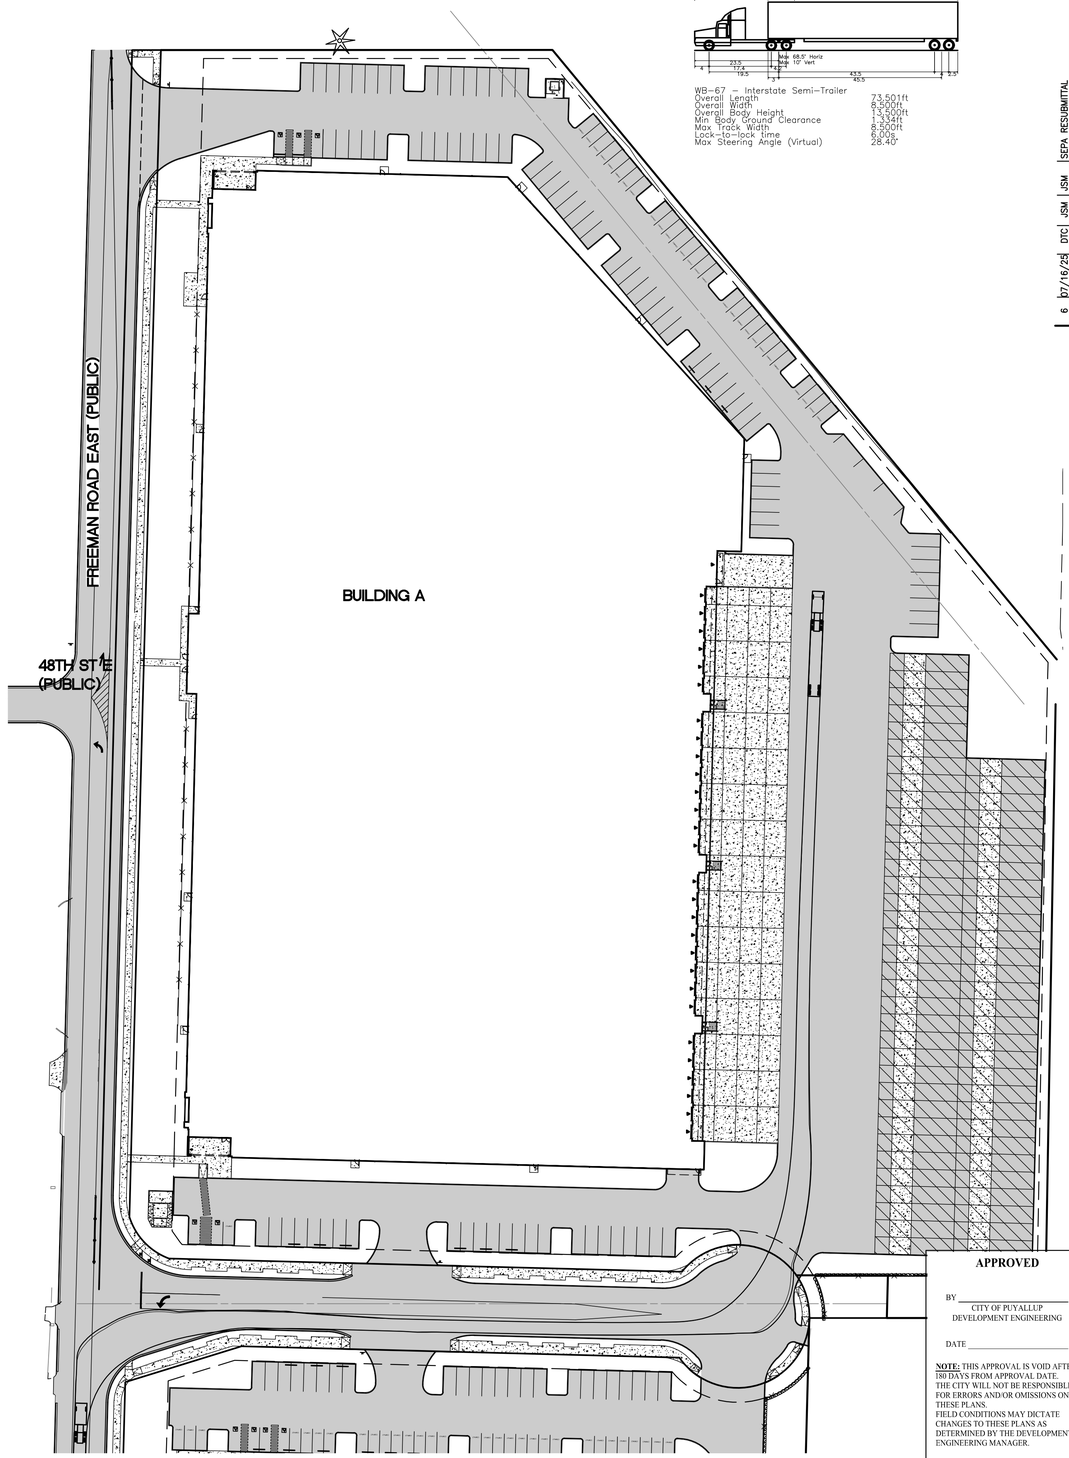

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title:

PRELIMINARY SITE CIRCULATION EXHIBIT - NORTH
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MARSH
STATE OF WASHINGTON
54927
REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=50' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Job Number 21585

Sheet C47 of 48

P:\21000s\21585\engineering\SEPA SET\21585-TT.dwg 7/16/2025 10:52 AM DCASEY


PRELIMINARY SITE CIRCULATION EXHIBIT - SOUTH


OF

FREEMAN LOGISTICS


PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

0 25' 50' 100'
SCALE: 1"=50'

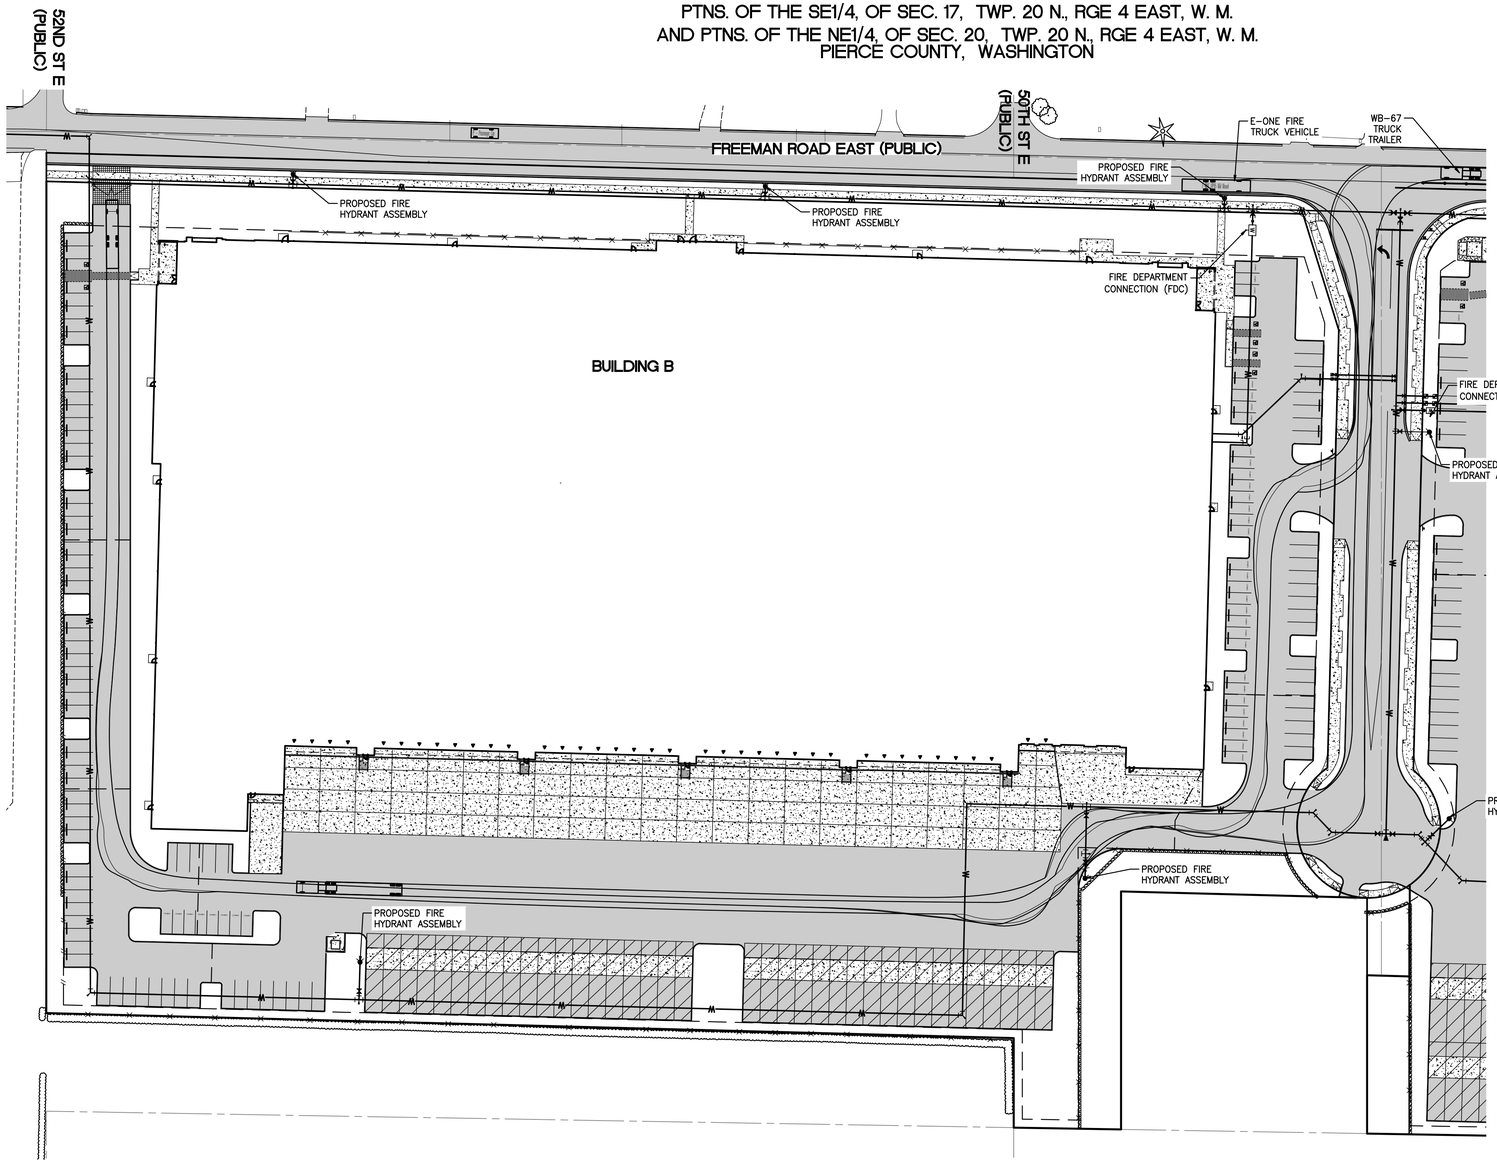

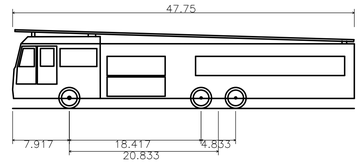

E-ONE HP95 Mid Mount	
Overall Length	47.750ft
Overall Width	8.333ft
Overall Body Height	11.000ft
Min Body Ground Clearance	1.393ft
Track Width	8.333ft
Lock-to-lock time	6.00s
Max Wheel Angle	45.00°

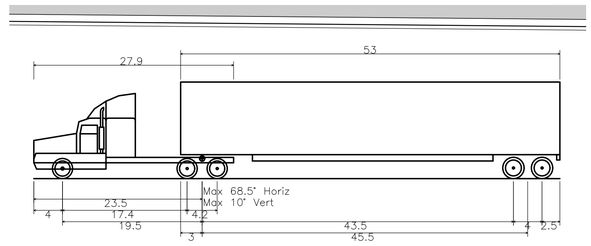

WB-67 - Interstate Semi-Trailer	
Overall Length	73.501ft
Overall Width	8.500ft
Overall Body Height	13.500ft
Min Body Ground Clearance	1.334ft
Max Track Width	8.500ft
Lock-to-lock time	6.00s
Max Steering Angle (Virtual)	28.40°

INTERSECTION SIGHT DISTANCE

INTERSECTION SIGHT DISTANCE (ISD) = 1.47*V*tg

WHERE V = DESIGN SPEED (MPH)
SITE POSTED AS 25 MPH ZONE, USE 35 MPH FOR DESIGN SPEED
tg = TIME GAP FOR THE PARTICULAR SCENARIO (TYPE OF MANEUVER AND VEHICLE)

tg = 6.5 SECONDS FOR PASSENGER VEHICLE TURNING RIGHT
tg = 7.5 SECONDS FOR PASSENGER VEHICLE TURNING LEFT
tg = 10.5 SECONDS FOR COMBINATION TRUCK VEHICLE TURNING RIGHT
tg = 11.5 SECONDS FOR COMBINATION TRUCK VEHICLE TURNING LEFT
PER AASHTO GREEN BOOK EDITION 7


STOPPING SIGHT DISTANCE

STOPPING SIGHT DISTANCE (SSD) = 1.47*V*tb + V^2/30[(a/32.2)+G]

WHERE V = DESIGN SPEED (MPH)
SITE POSTED AS 25 MPH ZONE, USE 35 MPH FOR DESIGN SPEED
tb = BRAKE REACTION TIME, EQUAL TO 2.5 SECONDS
PER AASHTO GREEN BOOK EDITION 7

a = DECELERATION, RECOMMENDED VALUE 11.2 FT/S^2
G = GRADE, RISE/RUN (FT/FT)

FOR A LEVEL APPROACH, WITH DESIGN SPEED EQUAL TO 35 MPH, SSD = 250'

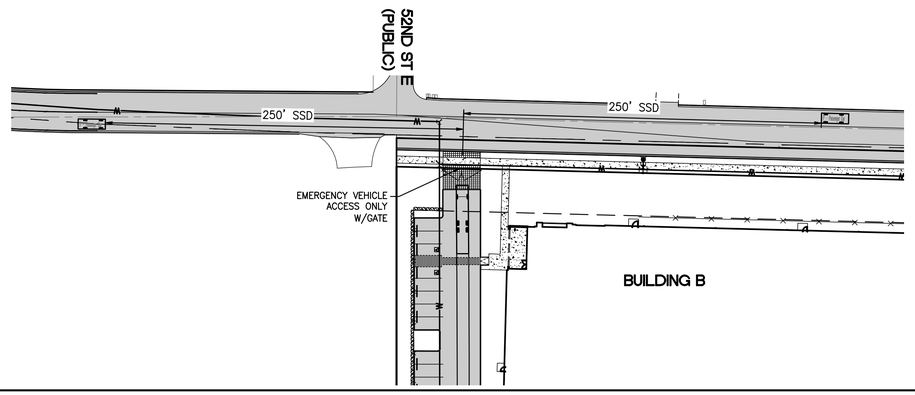

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	07/16/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY SITE CIRCULATION EXHIBIT - SOUTH** FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDLE — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
7/16/25

Scale: Horizontal 1"=50' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/16/25


Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**


Job Number 21585

Sheet **C48** of 48

P:\21000s\21585\engineering\SEPA SET\21585-TT.dwg 7/16/2025 10:52 AM DCASEY

PORTION OF SECTIONS 17 & 20, TOWNSHIP 20 N, RANGE 4 EAST, W.M., PIERCE COUNTY, WASHINGTON

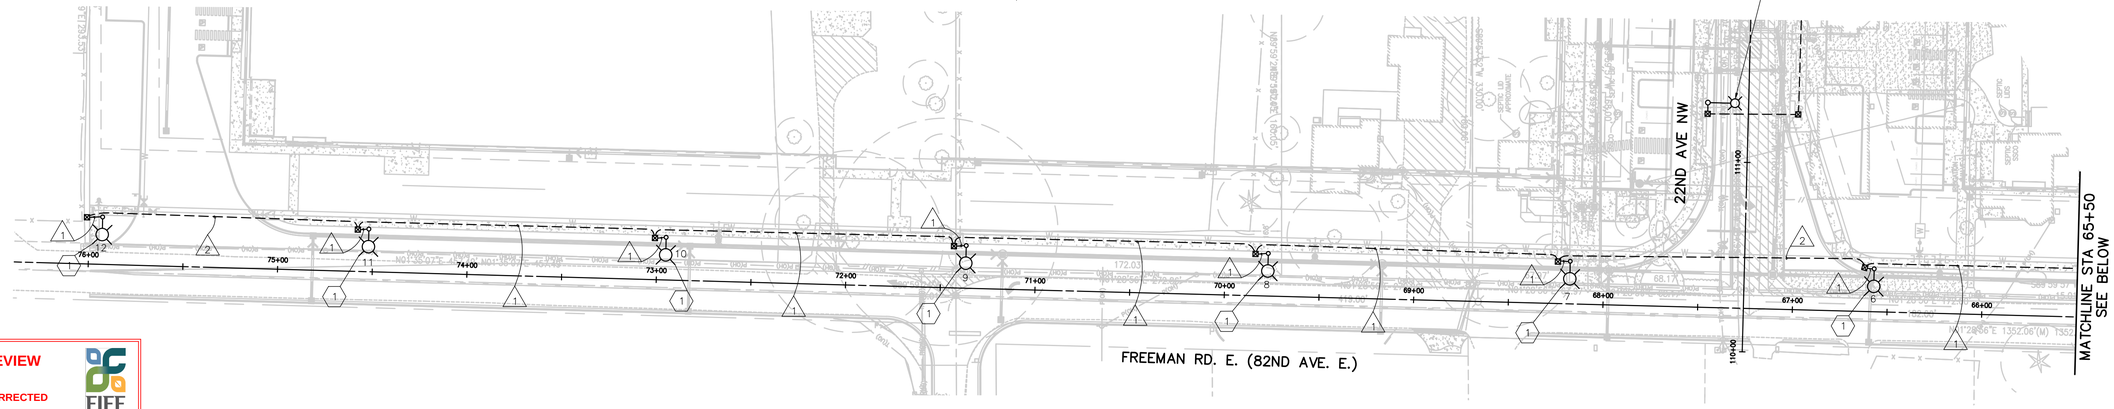

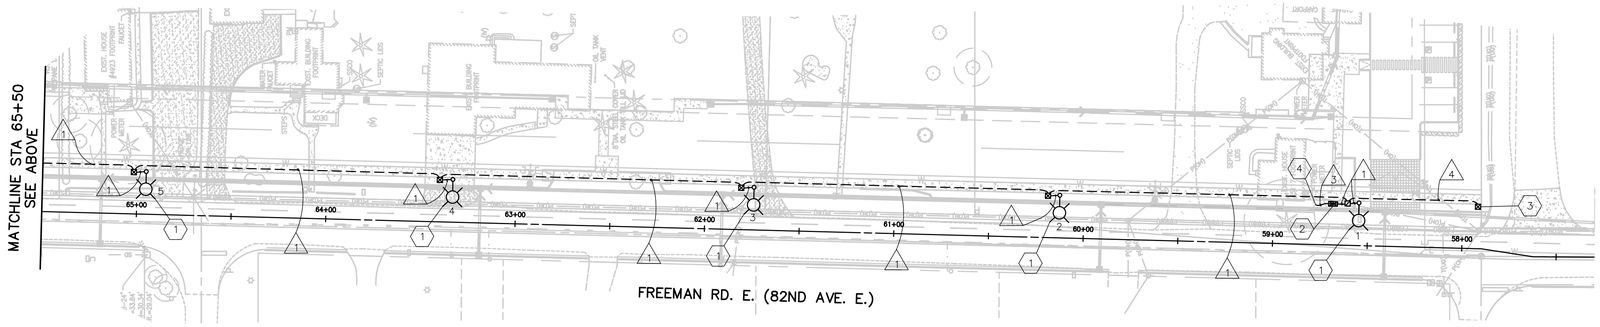


ENGINEER'S REVIEW

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☑ FOR INFORMATION ONLY

The City's review is not a confirmation of any dimension or quantities shown in the plans and will not relieve the Developer or Engineer from responsibility for plan errors. No changes shall be made to the plans except with the consent of the City Engineer. If construction has not commenced within a reasonable period of the approval date, plans will require re-approval by the City.

BY tosborne **DATE** 9/10/2025



GENERAL NOTES

1. ALL WORK SHALL BE IN ACCORDANCE WITH THESE PLANS, CITY OF FIFE STANDARD DETAILS AND DRAWINGS, WASHINGTON STATE DEPARTMENT OF TRANSPORTATION (WSDOT) STANDARD SPECIFICATIONS FOR ROAD, BRIDGE AND MUNICIPAL CONSTRUCTION, AND WSDOT STANDARD PLANS (ALL CURRENT VERSIONS).
2. THE LOCATIONS OF UTILITIES AND FEATURES SHOWN ARE APPROXIMATE AND SHALL BE VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO CONSTRUCTION START.
3. ALL OVERHEAD POWER LINES SHALL BE UNDERGROUNDED ALONG PROJECT FRONTAGE. NO LIGHT STANDARDS SHALL BE ERECTED PRIOR TO UNDERGROUNDING.
4. ALL WORK SHALL BE CONSISTENT WITH UTILITY AGENCY REQUIREMENTS. THE CONTRACTOR SHALL COORDINATE WITH AFFECTED UTILITY AGENCIES THROUGHOUT THE PROJECT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO UTILITIES.
5. CONDUIT AND JUNCTION BOX LOCATIONS ARE SHOWN FOR ILLUSTRATIVE PURPOSES. ACTUAL LOCATIONS SHALL BE DETERMINED BY THE CONTRACTOR IN THE FIELD WITH DIRECTION FROM THE CITY.

CONSTRUCTION NOTES

1. CONSTRUCT 2' DIAMETER FOUNDATION PER CITY OF FIFE STANDARD DETAIL IL1. INSTALL NEW HAPCO RTA LIGHT STANDARD WITH 6' ARM AND AEL (ATBM-P40-MVOLT-R2-NL-P7) LED FIXTURE WITH TYPE 2 DISTRIBUTION PER LUMINAIRE SCHEDULE. INSTALL TYPE 1 JUNCTION BOX WITHIN 6' OF LIGHT STANDARD PER WSDOT STANDARD PLAN J-40.10-04.
2. CONSTRUCT FOUNDATION AT APPROXIMATELY STA 58+69, 22' RT AND INSTALL NEW 200 AMP TYPE D SERVICE CABINET PER WSDOT STANDARD PLANS J-10.10-04 AND J-10.21-02.
3. INSTALL NEW TYPE 1 OR TYPE 2 JUNCTION BOX PER WSDOT STANDARD PLAN J-40.10-04.
4. COORDINATE WITH ELECTRIC UTILITY FOR POINT OF SERVICE. ROUTE SERVICE ENTRANCE CONDUIT AND CONDUCTORS TO POINT OF SERVICE PER UTILITY REQUIREMENTS. COORDINATE WITH UTILITY FOR SERVICE CONNECTION.

LUMINAIRE SCHEDULE

LUM. NO.	CIRCUIT NO.	LOCATION	OFFSET (FEET)	LAMP TYPE	MAST ARM (FEET)	MOUNTING HGT. (FT.)	POLE H1 HGT. (FT.)	FOUNDATION TYPE	REMARKS
1	A	FREEMAN RD 58+54.84	22.50 RT	LED	6	35	35	A	ATBM P40 R2
2	A	FREEMAN RD 60+12.83	22.50 RT	LED	6	35	35	A	ATBM P40 R2
3	A	FREEMAN RD 61+74.33	22.50 RT	LED	6	35	35	A	ATBM P40 R2
4	A	FREEMAN RD 63+33.37	22.50 RT	LED	6	35	35	A	ATBM P40 R2
5	A	FREEMAN RD 64+95.33	22.50 RT	LED	6	35	35	A	ATBM P40 R2
6	A	FREEMAN RD 66+57.34	22.65 RT	LED	6	35	35	A	ATBM P40 R2
7	A	FREEMAN RD 68+17.84	22.50 RT	LED	6	35	35	A	ATBM P40 R2
8	A	FREEMAN RD 69+77.34	22.50 RT	LED	6	35	35	A	ATBM P40 R2
9	A	FREEMAN RD 71+36.84	22.50 RT	LED	6	35	35	A	ATBM P40 R2
10	A	FREEMAN RD 72+95.38	22.50 RT	LED	6	35	35	A	ATBM P40 R2
11	A	FREEMAN RD 74+52.38	22.50 RT	LED	6	35	35	A	ATBM P40 R2
12	A	FREEMAN RD 75+93.05	25.00 RT	LED	6	35	35	A	ATBM P40 R2

WIRING SCHEDULE

△ NO.	RACEWAY	CONDUCTORS
1	2" SCH 40	2-#6, 1-#6 GROUND
2	2" SCH 80	2-#6, 1-#6 GROUND
3	3" SCH 80	3-250 KCMIL, POWER
4	2" SCH 80	SPARE, INSTALL PULL CORD

LEGEND

NEW

- LUMINAIRE
- CONDUIT (SEE WIRING SCHEDULE)
- TYPE 1 JUNCTION BOX
- TYPE 2 JUNCTION BOX
- ELECTRICAL SERVICE CABINET
- △ WIRE NOTE
- ⬡ CONSTRUCTION NOTE

APPROVED FOR CONSTRUCTION

ENGINEERING MANAGER	DATE
PROJECT MANAGER	DATE
PROJECT ENGINEER	DATE

CAUTION:
LOCATION OF EXISTING UTILITIES SHOWN IS APPROXIMATE AND MAY NOT BE ACCURATE OR ALL INCLUSIVE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO POTHOLE AS REQUIRED AND FIELD VERIFY LOCATION OF UTILITIES PRIOR TO PROCEEDING WITH CONSTRUCTION.

UNDERGROUND UTILITY NOTE:
YOU MUST CALL 811 NOT LESS THAN 72 HOURS BEFORE BEGINNING EXCAVATION WHERE ANY UNDERGROUND UTILITIES MAY BE LOCATED. FAILURE TO DO SO COULD MEAN BEARING SUBSTANTIAL REPAIR COSTS (UP TO THREE TIMES THE COST OF REPAIRS TO THE SERVICE).

DRAWN	RMH				
DESIGNED	RMH				
CHECKED	7/7/25 RMH				
PROJ. ENGR.					
DRAWING FILE	IL_rev1.DWG				
		DATE	REVISION	BY	APP'D

FOR:
CRP/VDC FREEMAN LOGISTICS OWNER, LLC
11411 NE 124th St., Suite 190
Kirkland, WA 98034

ROBERT MARTIN HERMAN — STATE OF WASHINGTON — 19730 — REGISTERED PROFESSIONAL ENGINEER — 7-7-25

HTE HERMAN TRAFFIC ENGINEERING, INC.
11215 Southeast 220th Place, Kent, Washington 98031
253-236-4941 tel. bob@hte-inc.com

FREEMAN LOGISTICS
CITY OF PUYALLUP/CITY OF FIFE

ILLUMINATION PLAN (CITY OF FIFE)
FREEMAN RD. E.

IL1

SHEET OF SHEETS

PORTION OF SECTIONS 17 & 20, TOWNSHIP 20 N, RANGE 4 EAST, W.M.,
PIERCE COUNTY, WASHINGTON


LEGEND

NEW

- LUMINAIRE
- CONDUIT (SEE WIRING SCHEDULE)
- TYPE 1 JUNCTION BOX
- ELECTRICAL SERVICE CABINET
- WIRE NOTE
- CONSTRUCTION NOTE

NORTH

20 0 20 40
scale feet

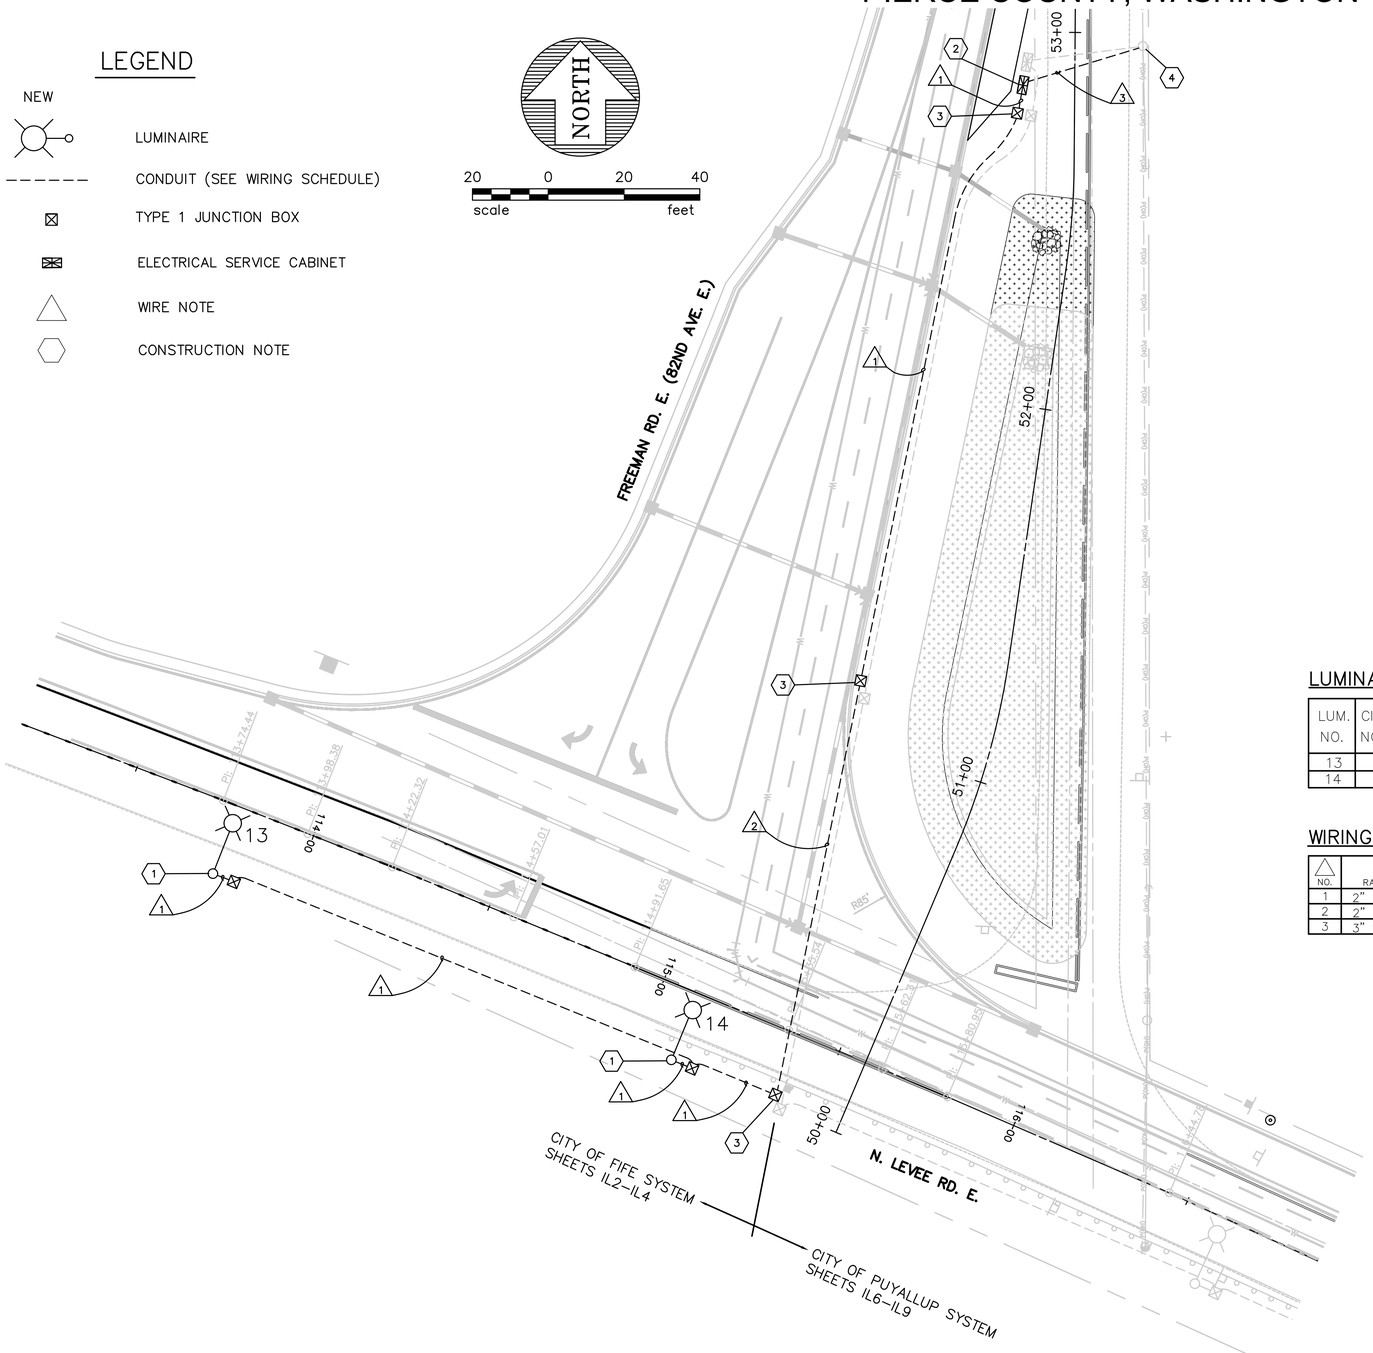

GENERAL NOTES

1. ALL WORK SHALL BE IN ACCORDANCE WITH THESE PLANS, CITY OF FIFE STANDARD DETAILS AND DRAWINGS, WASHINGTON STATE DEPARTMENT OF TRANSPORTATION (WSDOT) STANDARD SPECIFICATIONS FOR ROAD, BRIDGE AND MUNICIPAL CONSTRUCTION, AND WSDOT STANDARD PLANS (ALL CURRENT VERSIONS).
2. THE LOCATIONS OF UTILITIES AND FEATURES SHOWN ARE APPROXIMATE AND SHALL BE VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO CONSTRUCTION START.
3. ALL WORK SHALL BE CONSISTENT WITH UTILITY AGENCY REQUIREMENTS. THE CONTRACTOR SHALL COORDINATE WITH AFFECTED UTILITY AGENCIES THROUGHOUT THE PROJECT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO UTILITIES.
4. CONDUIT AND JUNCTION BOX LOCATIONS ARE SHOWN FOR ILLUSTRATIVE PURPOSES. ACTUAL LOCATIONS SHALL BE DETERMINED BY THE CONTRACTOR IN THE FIELD WITH DIRECTION FROM THE CITY.

CONSTRUCTION NOTES

1. CONSTRUCT 2' DIAMETER FOUNDATION PER CITY OF FIFE STANDARD DETAIL IL1. INSTALL NEW HAPCO RTA LIGHT STANDARD WITH 8' ARM AND AEL (ATBM–P40–MVOLT–R2–NL–P7) LED FIXTURE WITH TYPE 2 DISTRIBUTION PER LUMINAIRE SCHEDULE. INSTALL TYPE 1 JUNCTION BOX WITHIN 6' OF LIGHT STANDARD PER WSDOT STANDARD PLAN J–40.10–04.
2. CONSTRUCT FOUNDATION AT APPROXIMATELY STA 52+86, 13.5' LT AND INSTALL NEW 200 AMP TYPE D SERVICE CABINET PER WSDOT STANDARD PLANS J–10.10–04 AND J–10.21–02.
3. INSTALL NEW TYPE 1 JUNCTION BOX PER WSDOT STANDARD PLAN J–40.10–04.
4. ROUTE SERVICE ENTRANCE CONDUIT AND CONDUCTORS TO NEW UTILITY POLE TO BE INSTALLED BY PUGET SOUND ENERGY (PSE) PER PSE REQUIREMENTS. COORDINATE WITH PSE FOR SERVICE CONNECTION.

LUMINAIRE SCHEDULE

LUM. NO.	CIRCUIT NO.	LOCATION	OFFSET (FEET)	LAMP TYPE	MAST ARM (FEET)	MOUNTING HGT. (FT.)	POLE H1 HGT. (FT.)	FOUNDATION TYPE	REMARKS
13	A	LEVEE RD 113+78.93	19.00 RT	LED	12	32	35	B	ATBM P40 R2
14	A	LEVEE RD 115+09.83	19.00 RT	LED	12	32	35	B	ATBM P40 R2

WIRING SCHEDULE

△ NO.	RACEWAY	CONDUCTORS
1	2" SCH 40	2–#8, 1–#8 GROUND
2	2" SCH 80	2–#8, 1–#8 GROUND
3	3" SCH 80	3–250 KCMIL, POWER

APPROVED FOR CONSTRUCTION

ENGINEERING MANAGER DATE

PROJECT MANAGER DATE

PROJECT ENGINEER DATE

CAUTION:
LOCATION OF EXISTING UTILITIES SHOWN IS APPROXIMATE AND MAY NOT BE ACCURATE OR ALL INCLUSIVE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO POTHOLE AS REQUIRED AND FIELD VERIFY LOCATION OF UTILITIES PRIOR TO PROCEEDING WITH CONSTRUCTION.

UNDERGROUND UTILITY NOTE:
YOU MUST CALL 811 NOT LESS THAN 72 HOURS BEFORE BEGINNING EXCAVATION WHERE ANY UNDERGROUND UTILITIES MAY BE LOCATED. FAILURE TO DO SO COULD MEAN BEARING SUBSTANTIAL REPAIR COSTS (UP TO THREE TIMES THE COST OF REPAIRS TO THE SERVICE).

DRAWN	RMH				
DESIGNED	RMH				
CHECKED	7/7/25 RMH				
PROJ. ENGR.					
DRAWING FILE	IL_rev1.DWG				
		DATE	REVISION	BY	APP'D

FOR:
CRP/VDC FREEMAN LOGISTICS OWNER, LLC
11411 NE 124th St., Suite 190
Kirkland, WA 98034

ROBERT MARTIN HERMAN — STATE OF WASHINGTON — 30730 — REGISTERED PROFESSIONAL ENGINEER — 7-7-25

HTE HERMAN TRAFFIC ENGINEERING, INC.
11215 Southeast 220th Place, Kent, Washington 98031
253-236-4941 tel. bob@hte-inc.com


FREEMAN LOGISTICS
CITY OF PUYALLUP/CITY OF FIFE

ILLUMINATION PLAN (CITY OF FIFE)
FREEMAN RD. E./N. LEVEE RD. E.

IL2

SHEET OF SHEETS

DRAWN BY: BILL BERENS

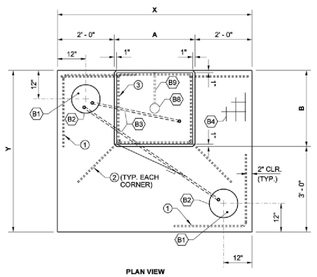

PLAN VIEW

KEY NOTES - SHEET 3 OF 6

(B1) Ground rod ~ See Note B1, this sheet.

(B2) Ground rod well (Ground tile) - 12" diameter concrete

(B3) Service ground electrode conduits.

(B4) Welded wire fabric ~ See Note B2, this sheet.

(B5) Utility entrance (service cabinet) or input power (transformer cabinet) conduit. Conduit shall terminate in the utility or high-voltage section of the cabinet (as applicable).

(B6) Conduits to field equipment. Conduits shall terminate in the customer section (service cabinet) or low-voltage (transformer cabinet) of the cabinet.

(B7) Conduit couplers ~ See Note B4, this sheet.

(B8) 4" (in.) diam. x 1/2" (in.) deep sump.Slope foundation within cabinet footprint toward sump.

(B9) 3/8" (in.) diam. polyethylene or copper tubing for drain. Tubing shall be straight, but slope downward a minimum of 1" (in.).

NOTES - SINGLE PAD MOUNT SERVICE OR TRANSFORMER CABINET (SHEET 3 OF 6)

B1. Drive ground rods before placing concrete. Ground rods shall be a minimum of 6 feet apart. See **Standard Plan J-60.05** for additional details.

B2. Welded Wire Fabric (WWF) shall be 4.0 (in.) x 4.0 (in.) ~ W4.0 x W4.0 ~ meeting the requirements of **Standard Specification 9-07.7**. As an alternative, a grid of #3 rebar may be used, with bars spaced at 1'-0" centers laterally and longitudinally.

B3. Omit concrete riser and bar #3 for Type D and Type E service cabinets.


B4. Install conduit couplings on all conduits. Couplers shall be installed with the top of the coupler flush with the top of concrete. For PVC conduits, the conduit segment above the coupler shall not be glued to the coupler.

B5. Conduits shall extend a minimum of 2" (in.) and a maximum of 3" (in.) into the cabinet, as measured from the concrete surface to the top of the end bell (PVC) or ground bushing (RMC).

B6. Serving utility may require meter socket to be installed on the outside of the cabinet. Utility feeder conduit shall still terminate in the utility section of the cabinet unless otherwise required by the utility.

B7. Additional gravel pad not shown. Gravel pad shall extend two feet in front of the concrete pad for the full width of the concrete pad. If the utility meter socket is installed on the outside of the service cabinet, gravel pad shall also extend three feet from the side of the cabinet pad where the meter is installed. Final gravel area shall be a rectangle.

B8. See **Standard Plan J-10.14** for additional details when service or transformer cabinet is installed in fence line.

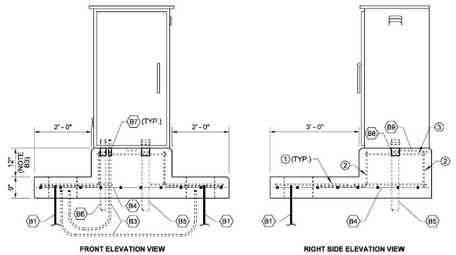


SINGLE PAD MOUNT
SERVICE OR TRANSFORMER CABINET
(XFMR-L CABINET SHOWN)

FOUNDATION SIZE REFERENCE TABLE

SERVICE CABINETS	PAD WIDTH (X)	PAD DEPTH (Y)	RISER WIDTH (A)	RISER DEPTH (B)	HOOP ③ WIDTH (BA)	HOOP ③ DEPTH (BB)
TYPE D	6' - 4"	3' - 8"	N/A	N/A	N/A	N/A
TYPE E	8' - 4"	3' - 8"	N/A	N/A	N/A	N/A
TRANSFORMER CABINETS	**PAD WIDTH (X)**	**PAD DEPTH (Y)**	**RISER WIDTH (A)**	**RISER DEPTH (B)**	**HOOP ③ WIDTH (BA)**	**HOOP ③ DEPTH (BB)**
XFMR-S (UP TO 12.5 KVA)	6' - 2"	4' - 11"	2' - 2"	1' - 11"	1' - 10"	1' - 7"
XFMR-L (12.6 TO 37.5 KVA)	6' - 10"	5' - 8"	2' - 10"	2' - 8"	2' - 6"	2' - 4"

REINFORCING STEEL BENDING DIAGRAM

SEE **STD. SPEC. 9-07.1(2)** FOR BENDING DIAM. ALL DIMENSIONS ARE OUT TO OUT



NOTE: BAR 3 DIMENSIONS ARE ALWAYS FOUR INCHES SMALLER THAN THEIR ASSOCIATED CONCRETE RISER DIMENSIONS.

WILLIAM FLINT JAKSON — STATE OF WASHINGTON — 46821 — REGISTERED PROFESSIONAL ENGINEER


Jaksons, Flint — Aug 24 2020 9:37 AM

CABINET ORIENTATION CONDUIT LAYOUT AND FOUNDATION DETAIL
STANDARD PLAN J-10.10-04

SHEET 3 OF 6 SHEETS

APPROVED FOR PUBLICATION
Date: 2020.09.16 10:07:52 -07'00'
STATE DESIGN ENGINEER
Washington State Department of Transportation

DRAWN BY: FERN LEDELL

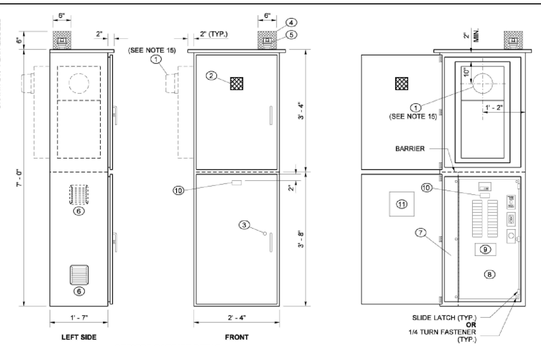

SERVICE CABINET DETAIL

KEY

(1) METER SOCKET/BASE PANEL PER UTILITY REQUIREMENTS ~ UTILITY MAY REQUIRE METER TO BE INSTALLED ON THE OUTSIDE OF THE CABINET INSTEAD OF INSIDE THE UTILITY SECTION OF THE CABINET

(2) UTILITY SECTION DOOR ~ HINGED FRONT FACING DOOR WITH 4" (IN) x 4" (IN) MINIMUM POLISHED WIRE GLASS WINDOW

(3) CUSTOMER SECTION DOOR WITH BEST CX 6-PIN LOCK CORE

(4) PHOTOCELL ENCLOSURE ~ SEE PHOTOCELL MOUNTING DETAIL ~ ENCLOSURE SHALL BE FABRICATED FROM EITHER:
- A. 5/8" (IN) EXPANDED STEEL MESH WITH WELDED SEAMS AND MOUNTING FLANGES ~ HOT-DIP GALVANIZED AFTER FABRICATION ~ OR ~
- B. TYPE 5052 - H32 ALUMINUM WITH 5/8" (IN) x 5/8" (IN) OPENINGS EQUIVALENT TO 5/8" (IN) EXPANDED STEEL MESH

(5) PHOTOELECTRIC CONTROL ~ SEE **STANDARD SPECIFICATION, SECTION 9-29.11(2).**

(6) SCREENED VENTS ~ TWO REQUIRED, ONE EACH SIDE ~ LOUVERED PLATES


(7) 6" (IN) x 6" (IN) MIN. UTILITY WIREWAY ~ BACK LEFT CORNER OF CUSTOMER SECTION ~ SHALL REQUIRE TOOLS TO OPEN ~ LABEL WITH "UTILITY WIREWAY"

(8) HINGED DEAD FRONT WITH (4) TURN FASTENERS OR SLIDE LATCHES ~ DEAD FRONT PANEL BOLTS SHALL NOT EXTEND INTO VERTICAL LIMITS OF THE BREAKER ARRAY(S)

(9) ARC FLASH AND SHOCK HAZARD LABEL (FIELD INSTALLED) ~ SEE DETAIL

(10) CABINET BUSSWORK RATING LABEL

(11) METAL WIRING DIAGRAM HOLDER



PHOTOCELL ENCLOSURE MOUNTING DETAIL

FRONT
(SHOWN WITH DOORS OPEN AND DEAD FRONT CLOSED)

SERVICE CABINET INTERIOR

NOTES

1. See **Standard Specification Section 9-29.24** (Service Cabinets).
2. Cabinet shall be rated NEMA 3R and shall include two rain-tight vents.
3. Dimensions shown are minimum and shall be adjusted to accommodate the various sizes of equipment installed. A 1% tolerance is allowed for all dimensions.
4. Doors shall be pad-lockable and gasketed. Customer side door shall include a Best CX 6-pin Construction core lock. Each door shall use either a continuous piano hinge, three two-piece hinges, or two heavy-duty lift-off type hinges.
5. Hinges with pins shall have stainless steel or brass pins - **see Standard Plan J-10.20** door hinge details. When using two piece hinge type on galvanized enclosure, remove hinge pin prior to welding hinge to cabinet and prior to hot-dip galvanizing. After galvanizing, replace pin with brass pin and solder in place.
6. Equipment identified by Key Numbers **14**, **16**, **17**, **18**, **19**, **20**, **21**, **22**, **23**, and **28** shall have an appropriately engraved phenolic name plate attached with screws or rivets. The name plate for Key Number 21 (Test Switch only) shall read as follows:
"PHOTOCELL BYPASS TEST ON" AND "PHOTOCELL TEST OFF - AUTOMATIC."
See service cabinet detail.
7. All busswork shall be **ASTM B187** copper and shall have a minimum rating of 250 amps. All breakers shall bolt on to the busswork. Jumpering of breakers shall not be allowed. Busswork shall accommodate all future equipment as shown in the Breaker Schedule.
8. All nuts, bolts, and washers used for mounting the photocell enclosure shall be stainless steel.
9. The photocell unit shall be centered in the photocell enclosure to permit 360 degree rotation of the photocell without removal of the photocell unit or the photocell enclosure.
10. All internal wire runs shall be identified with "TO - FROM" coded tags labeled with the code letters and/or numbers shown on the Schedules. Approved PVC or polyolefin wire marking sleeves shall be used.
11. Key items **23**, **24**, and **25** shall be connected to the cabinet main bonding jumper assembly by appropriately sized wire.
12. See Contract for Breaker and Contactor Schedule.
13. Buss bars shall be sized to accommodate up to #4 AWG wires.
14. The meter base portion of this service was designed to meet metering portion of **EUSERC Drawing 309** requirements.
15. Metering arrangements vary with different serving Utilities. The Utility may require meter base mounting in the enclosure, on the side, or on the back of the enclosure. The Utility may require the dimension between the door and the front of the safety socket box to be less than the 11" (in) shown in the Left Side - Safety Socket Box Mounting Detail. The Contractor shall verify the serving Utility's requirements prior to fabrication and installation of the service equipment.
16. Verify the meter setback position with the utility and adjust the meter socket backplate to the required position. For cabinets with separate metering, remove the meter socket or install shunts in the meter socket.

⚠ WARNING
Arc Flash and Shock Hazard
Appropriate PPE Required

ARC FLASH PROTECTION		SHOCK PROTECTION	
Arc Flash Boundary (in.)	88 in.	Shock Hazard When	600 VAC
At Maximum Power (cal/cm² @ 18 inches (calcm²))	8.89	Limited Approach	30 in.
Assessment Date	09-09-2022	Restricted Approach	30 in.
By		Glove Class	00
OSDOT Approval			
Inspector		Date	

ARC FLASH AND SHOCK HAZARD LABEL DETAIL (9)

WILLIAM FLINT JAKSON — STATE OF WASHINGTON — 46821 — REGISTERED PROFESSIONAL ENGINEER

Aug 18, 2021

SERVICE CABINET TYPE D
(0 - 200 AMP TYPE 120/240 VOLT SINGLE PHASE)
STANDARD PLAN J-10.21-02

SHEET 1 OF 2 SHEETS

APPROVED FOR PUBLICATION
Aug 18, 2021
STATE DESIGN ENGINEER
Washington State Department of Transportation

DRAWN BY: FERN LEDELL

KEY (CONTINUED)

(12) ALUMINUM BACKPLATE FOR METER SOCKET/BASE

(13) 18" (IN) WIDE BY 40" (IN) TALL ALUMINUM BACKPLATE FOR CUSTOMER SECTION EQUIPMENT

(14) MAIN BREAKER ~ DPST ~ SIZE PER BREAKER SCHEDULE

(15) 24-CIRCUIT PANEL BOARD ~ MINIMUM SIZE WITH SEPARATE MAIN BREAKER

(16) 20 KA TYPE 1 OR TYPE 2 SURGE PROTECTION DEVICE ~ DIN RAIL MOUNT WITH PLUG-IN MODULE(S)

(17) DPST BRANCH BREAKER ~ SEE BREAKER SCHEDULE

(18) SPARE BRANCH BREAKER ~ 20 AMP DPST ~ OMIT IF BREAKER ARRAY IS FULL (SEE BREAKER SCHEDULE)

(19) PHOTOCELL BREAKER ~ SPST 15 AMP

(20) RECEPTACLE BREAKER ~ SPST 20 AMP

(21) HEATER BREAKER ~ SPST 15 AMP

(22) SPST BRANCH BREAKER ~ SEE BREAKER SCHEDULE

(23) SINGLE GANG BOX WITH TEST SWITCH ~ 120/277 VOLT 15 AMP SPDT SNAP ACTION - POSITIVE CLOSE - "T" RATED

(24) SINGLE GANG BOX WITH RECEPTACLE (GROUNDED) ~ 125 VOLT 20 AMP GFCI

(25) SINGLE GANG BOX WITH THERMOSTAT CONTROL ~ 40° F CLOSURE - 3 DIFFERENTIAL


(26) ISOLATED NEUTRAL BUSS ~ 14 LUG COPPER (SEE NOTE 12)

(27) CABINET MAIN BONDING JUMPER ASSEMBLY ~ BUSS SHALL BE 14 LUG TINNED COPPER (SEE NOTE 12) ~ SEE CABINET MAIN BONDING JUMPER ASSEMBLY DETAIL


(28) CONTACTOR (BEHIND DEAD FRONT) ~ SEE BREAKER SCHEDULE

(29) STRIP HEATER (100 WATT NOMINAL) WITH EXPANDED STEEL MESH ENCLOSURE FOR TOUCH PROTECTION

(30) THREE POSITION DIN RAIL MOUNTED TERMINAL BLOCK ~ TERMINAL BLOCK SECTIONS SHALL BE BLACK, WHITE, AND RED AS SHOWN IN CABINET WIRING DIAGRAM.

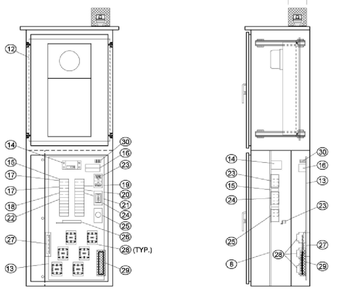


SERVICE CABINET INTERIOR DETAIL



UTILITY SECTION DETAIL



TEST SWITCH LABEL DETAIL
(23)

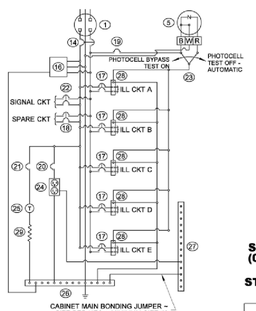

WIRING SCHEMATIC


WILLIAM FLINT JAKSON — STATE OF WASHINGTON — 46821 — REGISTERED PROFESSIONAL ENGINEER

Aug 18, 2021

SERVICE CABINET TYPE D
(0 - 200 AMP TYPE 120/240 VOLT SINGLE PHASE)
STANDARD PLAN J-10.21-02


SHEET 2 OF 2 SHEETS

APPROVED FOR PUBLICATION
Aug 18, 2021
STATE DESIGN ENGINEER
Washington State Department of Transportation

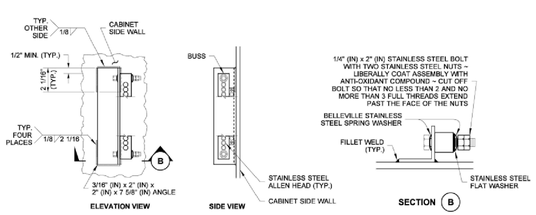

CABINET MAIN BONDING JUMPER ASSEMBLY DETAIL

DRAWN BY: LISA CLIFFORD





JUNCTION BOX DIMENSION TABLE


MARK	ITEM	BOX TYPE	
		TYPE 1	TYPE 2
A	OUTSIDE LENGTH OF JUNCTION BOX	22"	33"
B	OUTSIDE WIDTH OF JUNCTION BOX	17"	22 1/2"
C	INSIDE LENGTH OF JUNCTION BOX	18" ~ 19"	28" ~ 29"
D	INSIDE WIDTH OF JUNCTION BOX	13" ~ 14"	17" ~ 18"
E	LID LENGTH	17 5/8"	28 5/8"
F	LID WIDTH	12 5/8"	18 1/8"
	CAPACITY ~ CONDUIT DIAMETER	6"	12"

NOTES

1. All box dimensions are approximate. Exact configurations vary among manufacturers.
2. Minimum lid thickness shown. Junction Boxes installed in sidewalks, walkways, and shared-use paths shall have a slip-resistant coating on the lid and lip cover plate, and shall be installed with the surface flush with and matched to the grade of the sidewalk, walkway, or shared-use path. The non-slip lid shall be identified with permanent markings on the underside, indicating the type of surface treatment (see Contract Documents for details) and the year of manufacture. The permanent marking shall be 1/8" (in) line thickness formed with a mild steel weld bead and shall be placed prior to hot-dip galvanizing.
3. Lid support members shall be 3/16" (in) minimum thick steel C, L, or T shape, welded to the frame.
4. A 1/4-20 NC × 3/4" (in) stainless steel ground stud shall be welded to the bottom of the lid; include (2) stainless steel nuts and (2) stainless steel flat washers.
5. Bolts and nuts shall be liberally coated with anti-seize compound.
6. Equipment Bonding Jumper shall be # 8 AWG min. × 4' (ft) of tinned braided copper.
7. The System Identification letters shall be 1/8" (in) line thickness formed with a mild steel weld bead. See Cover Marking detail. Grind off diamond pattern before forming letters. For System Identification details, see **Standard Specification 9-29.2(4)**.
8. When required in the Contract, provide a 10" (in) x 27 1/2" (in), 10 gage divider plate, complete, with fasteners, in each Type 2 Junction Box where specified.
9. When required in Contract, provide a 12" (in) deep extension for each Type 2 Junction Box where specified.
10. See the **Standard Specifications** for alternative reinforcement and class of concrete.
11. Headed Anchor Shear Studs must be welded to the Steel Cover Lip Plate and wire tied in two places to the vertical Welded Wire Fabric when in contact with each other. Wire tie all other Headed Anchor Shear Studs to the horizontal Welded Wire Fabric.
12. Lid Bolt Down Attachment Tab provides a method of retrofitting by using a mechanical process in lieu of welding. Attachment Tab shown depicts a typical component arrangement; actual configurations of assembly will vary among manufacturers. See approved manufacturers' shop drawings for specifics.
13. Unless otherwise noted in the plans or approved by the Engineer, Junction Boxes, Cable Vaults, and Pull Boxes shall not be placed within the sidewalks, walkways, shared use paths, traveled ways or paved shoulders. All Junction Boxes, Cable Vaults, and Pull Boxes placed within the traveled way or paved shoulders shall be Heavy-Duty.
14. Distance between the top of the conduit and the bottom of the Junction Box lid shall be 6" (in) min. to 8" (in) max. for final grade of new construction only. See **Standard Specification 8-20.3(5)**. Where adjustments are to be made to existing Junction Boxes, or for interim construction stages during the contract, the limits shall be from 6" (in) min. to 10" (in) max. See **Standard Specification 8-20.3(6)**.

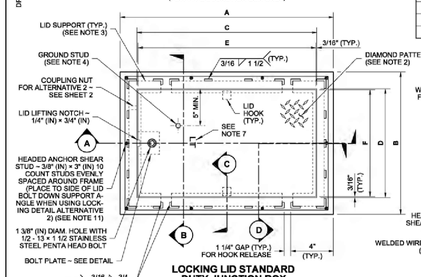




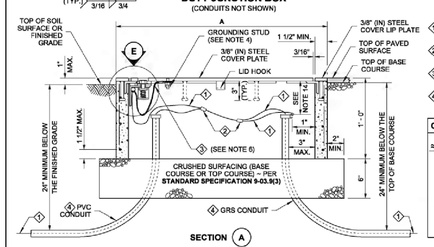

1. Equipment Grounding Conductor
2. Copper Solderless Crimp Connector
3. Equipment Bonding Jumper (See Note 6)
4. See Contract for conduit size and number

COVER MARKING DETAIL



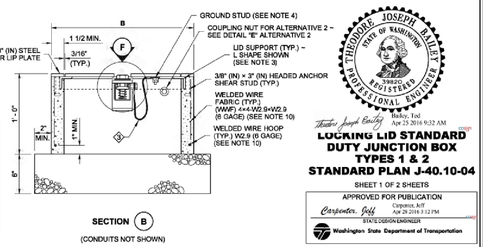

NOTES

1. All box dimensions are approximate. Exact configurations vary among manufacturers.
2. Minimum lid thickness shown. Junction Boxes installed in sidewalks, walkways, and shared-use paths shall have a slip-resistant coating on the lid and lip cover plate, and shall be installed with the surface flush with and matched to the grade of the sidewalk, walkway, or shared-use path. The non-slip lid shall be identified with permanent markings on the underside, indicating the type of surface treatment (see Contract Documents for details) and the year of manufacture. The permanent marking shall be 1/8" (in) line thickness formed with a mild steel weld bead and shall be placed prior to hot-dip galvanizing.
3. Lid support members shall be 3/16" (in) minimum thick steel C, L, or T shape, welded to the frame.
4. A 1/4-20 NC × 3/4" (in) stainless steel ground stud shall be welded to the bottom of the lid; include (2) stainless steel nuts and (2) stainless steel flat washers.
5. Bolts and nuts shall be liberally coated with anti-seize compound.
6. Equipment Bonding Jumper shall be # 8 AWG min. × 4' (ft) of tinned braided copper.
7. The System Identification letters shall be 1/8" (in) line thickness formed with a mild steel weld bead. See Cover Marking detail. Grind off diamond pattern before forming letters. For System Identification details, see **Standard Specification 9-29.2(4)**.
8. When required in the Contract, provide a 10" (in) x 27 1/2" (in), 10 gage divider plate, complete, with fasteners, in each Type 2 Junction Box where specified.
9. When required in Contract, provide a 12" (in) deep extension for each Type 2 Junction Box where specified.
10. See the **Standard Specifications** for alternative reinforcement and class of concrete.
11. Headed Anchor Shear Studs must be welded to the Steel Cover Lip Plate and wire tied in two places to the vertical Welded Wire Fabric when in contact with each other. Wire tie all other Headed Anchor Shear Studs to the horizontal Welded Wire Fabric.
12. Lid Bolt Down Attachment Tab provides a method of retrofitting by using a mechanical process in lieu of welding. Attachment Tab shown depicts a typical component arrangement; actual configurations of assembly will vary among manufacturers. See approved manufacturers' shop drawings for specifics.
13. Unless otherwise noted in the plans or approved by the Engineer, Junction Boxes, Cable Vaults, and Pull Boxes shall not be placed within the sidewalks, walkways, shared use paths, traveled ways or paved shoulders. All Junction Boxes, Cable Vaults, and Pull Boxes placed within the traveled way or paved shoulders shall be Heavy-Duty.
14. Distance between the top of the conduit and the bottom of the Junction Box lid shall be 6" (in) min. to 8" (in) max. for final grade of new construction only. See **Standard Specification 8-20.3(5)**. Where adjustments are to be made to existing Junction Boxes, or for interim construction stages during the contract, the limits shall be from 6" (in) min. to 10" (in) max. See **Standard Specification 8-20.3(6)**.

THEODORE JOSEPH BALLEY — STATE OF WASHINGTON — 39820 — REGISTERED PROFESSIONAL ENGINEER

Theodore Joseph Bailey — Bailey, Ted — Apr 25 2016 9:32 AM

LOCKING LID STANDARD DUTY JUNCTION BOX TYPES 1 & 2
STANDARD PLAN J-40.10-04

SHEET 1 OF 2 SHEETS

APPROVED FOR PUBLICATION
Carpenter, Jeff — Apr 29 2016 3:12 PM
STATE DESIGN ENGINEER
Washington State Department of Transportation

APPROVED FOR CONSTRUCTION

ENGINEERING MANAGER	**DATE**
PROJECT MANAGER	**DATE**
PROJECT ENGINEER	**DATE**

DRAWN	RMH				
DESIGNED	RMH				
CHECKED	7/7/25 RMH				
PROJ. ENGR.					
DRAWING FILE	IL_rev1.DWG				
	DATE	REVISION	BY	APP'D	

FOR:
CRP/VDC FREEMAN LOGISTICS OWNER, LLC
11411 NE 124th St., Suite 190
Kirkland, WA 98034

ROBERT MARTIN HERMAN — STATE OF WASHINGTON — 30730 — REGISTERED PROFESSIONAL ENGINEER
7-7-25

HTE HERMAN TRAFFIC ENGINEERING, INC.
11215 Southeast 220th Place, Kent, Washington 98031
253-236-4941 tel. bob@hte-inc.com


FREEMAN LOGISTICS
CITY OF PUYALLUP/CITY OF FIFE

CITY OF FIFE
ILLUMINATION DETAILS

IL3

SHEET OF SHEETS

DRAWN BY: LISA CYFORD

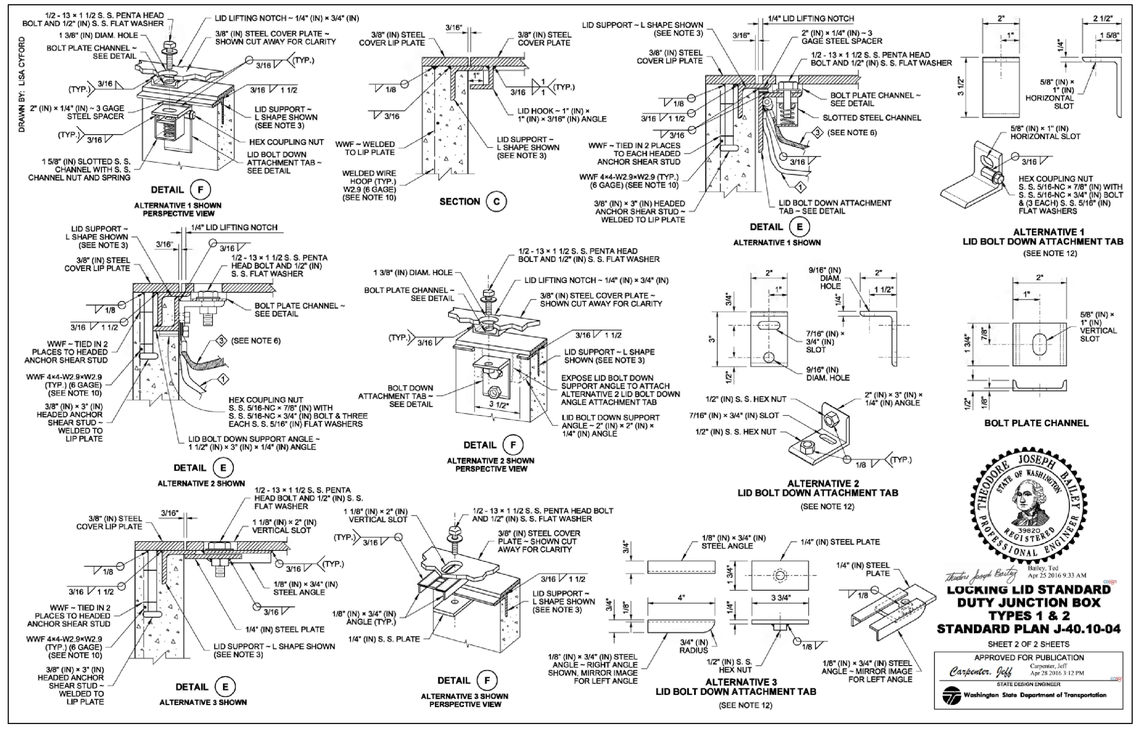


Theodore Joseph Bailey
STATE OF WASHINGTON
39820
REGISTERED PROFESSIONAL ENGINEER
Bailey, Ted
Apr 25 2016 9:33 AM

LOCKING LID STANDARD DUTY JUNCTION BOX TYPES 1 & 2 STANDARD PLAN J-40.10-04

SHEET 2 OF 2 SHEETS

APPROVED FOR PUBLICATION
Carpenter, Jeff
Apr 28 2016 3:12 PM
STATE DESIGN ENGINEER
Washington State Department of Transportation

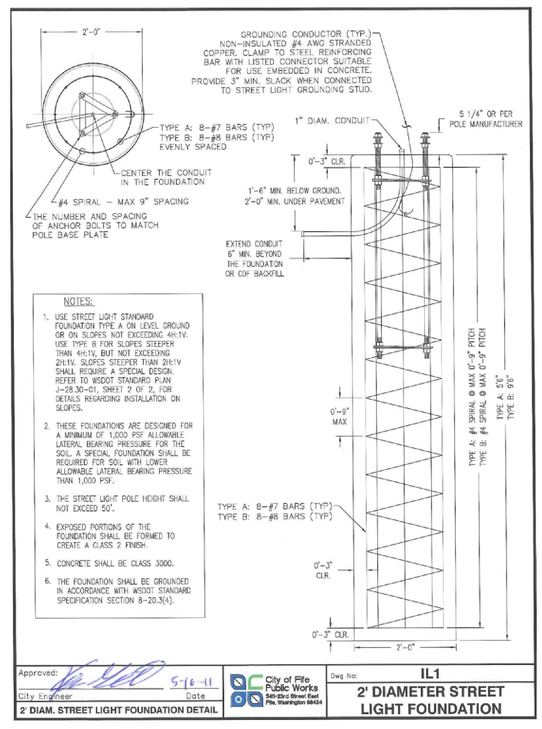

Approved: _____ 5-16-11
City Engineer Date

2' DIAM. STREET LIGHT FOUNDATION DETAIL

City of Fife Public Works
5411 23rd Street East
Fife, Washington 98424

Dwg No: IL1

2' DIAMETER STREET LIGHT FOUNDATION

APPROVED FOR CONSTRUCTION

ENGINEERING MANAGER DATE

PROJECT MANAGER DATE

PROJECT ENGINEER DATE

DRAWN	RMH				
DESIGNED	RMH				
CHECKED	7/7/25 RMH				
PROJ. ENGR.					
DRAWING FILE	IL_rev1.DWG				
		DATE	REVISION	BY	APP'D

FOR:

CRP/VDC FREEMAN LOGISTICS OWNER, LLC
11411 NE 124th St., Suite 190
Kirkland, WA 98034

ROBERT MARTIN HERMAN
STATE OF WASHINGTON
19730
REGISTERED PROFESSIONAL ENGINEER
7-7-25

HTE HERMAN TRAFFIC ENGINEERING, INC.
11215 Southeast 220th Place, Kent, Washington 98031
253-236-4941 tel. bob@hte-inc.com


FREEMAN LOGISTICS
CITY OF PUYALLUP/CITY OF FIFE

CITY OF FIFE
ILLUMINATION DETAILS

IL4

SHEET
OF
SHEETS

PORTION OF SECTIONS 17 & 20, TOWNSHIP 20 N, RANGE 4 EAST, W.M., PIERCE COUNTY, WASHINGTON

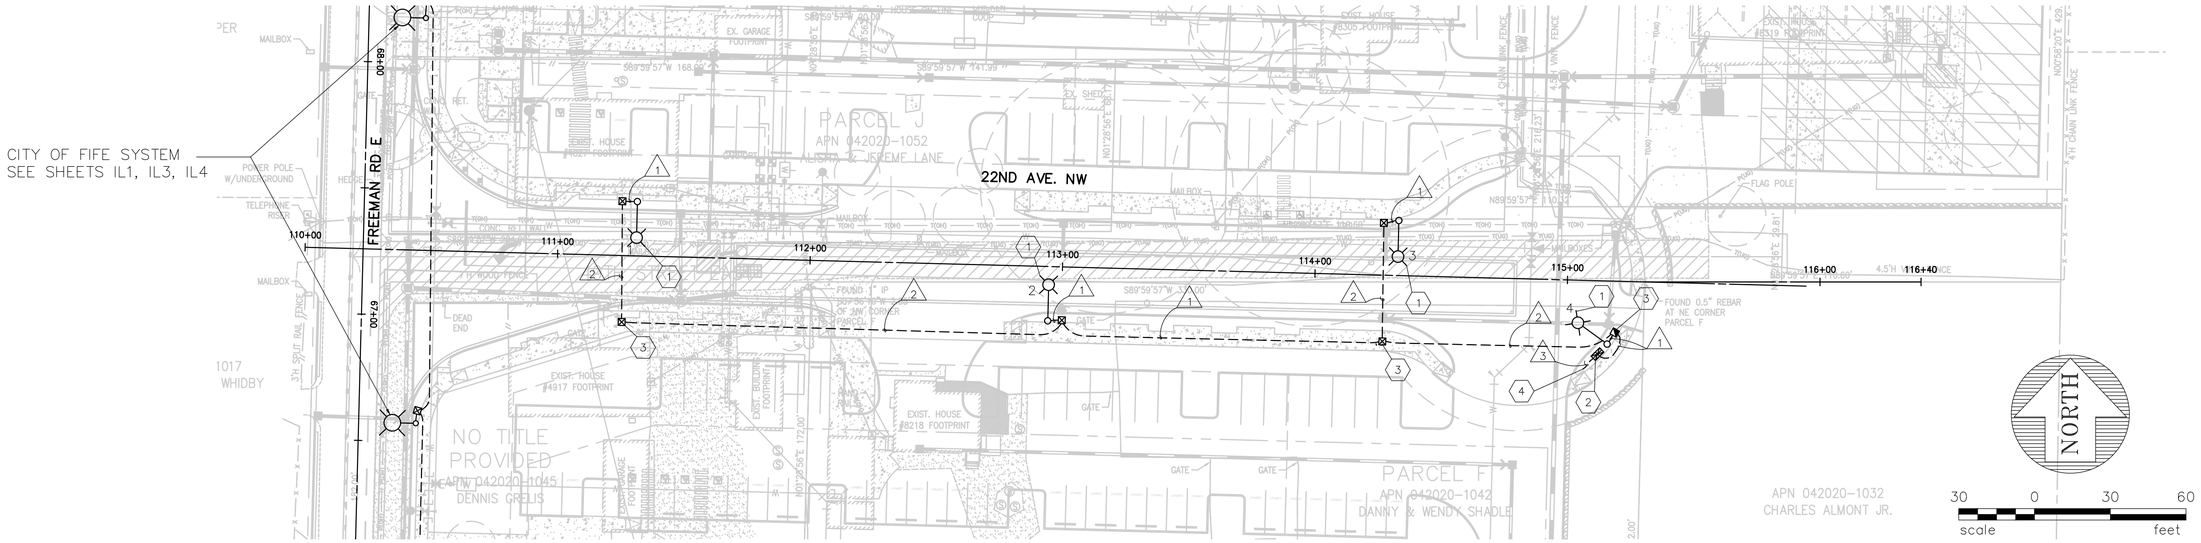

GENERAL NOTES

1. ALL WORK SHALL BE IN ACCORDANCE WITH THESE PLANS, CITY OF PUYALLUP CONSTRUCTION STANDARDS, WASHINGTON STATE DEPARTMENT OF TRANSPORTATION (WSDOT) STANDARD SPECIFICATIONS FOR ROAD, BRIDGE AND MUNICIPAL CONSTRUCTION, AND WSDOT STANDARD PLANS (ALL CURRENT VERSIONS).
2. THE LOCATIONS OF UTILITIES AND FEATURES SHOWN ARE APPROXIMATE AND SHALL BE VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO CONSTRUCTION START.
3. ALL OVERHEAD POWER LINES SHALL BE UNDERGROUNDED ALONG PROJECT FRONTAGE. NO LIGHT STANDARDS SHALL BE ERECTED PRIOR TO UNDERGROUNDING.
4. ALL WORK SHALL BE CONSISTENT WITH UTILITY AGENCY REQUIREMENTS. THE CONTRACTOR SHALL COORDINATE WITH AFFECTED UTILITY AGENCIES THROUGHOUT THE PROJECT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO UTILITIES.
5. CONDUIT AND JUNCTION BOX LOCATIONS ARE SHOWN FOR ILLUSTRATIVE PURPOSES. ACTUAL LOCATIONS SHALL BE DETERMINED BY THE CONTRACTOR IN THE FIELD WITH DIRECTION FROM THE CITY.
6. CONTRACTOR SHALL COORDINATE WITH THE CITY SIGNAL/ILLUMINATION TECHNICIAN AT 253.405.4390 PRIOR TO CONSTRUCTION.

CONSTRUCTION NOTES

(1) INSTALL CONCRETE FOUNDATION, TYPE 1 JUNCTION BOX, STEEL LUMINAIRE STANDARD WITH 12' ARM AND 65 WATT LEOTEK FIXTURE (GCM1-60J-40K-2R-GY-105-PCR7) PER LUMINAIRE SCHEDULE AND CITY OF PUYALLUP STANDARD DETAILS 01.05.01, 02, 03, 04, 06 AND 07. INSTALL SHORTING CAP.

(2) CONSTRUCT FOUNDATION AND INSTALL NEW STREET LIGHT SERVICE CABINET PER CITY OF PUYALLUP STANDARD DETAIL 01.05.05. INSTALL PHOTOCELL ON SERVICE CABINET.

(3) INSTALL NEW TYPE 1 OR TYPE 2 JUNCTION BOX PER CITY OF PUYALLUP STANDARD DETAIL 01.06.01.

(4) COORDINATE WITH ELECTRIC UTILITY FOR POINT OF SERVICE. ROUTE SERVICE ENTRANCE CONDUIT AND CONDUCTORS TO POINT OF SERVICE PER UTILITY REQUIREMENTS. COORDINATE WITH UTILITY FOR SERVICE CONNECTION.

LUMINAIRE SCHEDULE

LUM. NO.	CIRCUIT NO.	LOCATION	OFFSET (FEET)	LAMP WATTAGE	DAVIT ARM (FEET)	MOUNTING HGT. (FT.)	POLE H1 HGT. (FT.)
1	A	22ND AVE NW 111+31.04	21.50 LT	65W LED	12	30	30
2	A	22ND AVE NW 112+94.69	21.50 RT	65W LED	12	30	30
3	A	22ND AVE NW 114+32.65	21.50 LT	65W LED	12	30	30
4	A	22ND AVE NW 115+16.34	25.00 RT	65W LED	12	30	30

NOTE: INSTALL SHORTING CAPS ON ALL LUMINAIRES

WIRING SCHEDULE

RUN NO.	CONDUIT	CONDUCTORS	REMARKS
(1)	2" SCH 40 PVC	2-#8, 1-#8 GROUND	
(2)	2" SCH 80 PVC	2-#8, 1-#8 GROUND	
(3)	2" SCH 80 PVC	3-#2 SERVICE	

ALL PVC CONDUITS CONTAINING CONDUCTORS SHALL HAVE 1-#8 BARE GROUND WIRE

LEGEND

- LED LUMINAIRE, ARM AND ALUMINUM DAVIT STYLE POLE
- PVC CONDUIT (SEE WIRING SCHEDULE)
- TYPE 1 LOCKING JUNCTION BOX
- TYPE 2 LOCKING JUNCTION BOX
- (X) WIRING NOTE
- (X) CONSTRUCTION NOTE

CAUTION:
LOCATION OF EXISTING UTILITIES SHOWN IS APPROXIMATE AND MAY NOT BE ACCURATE OR ALL INCLUSIVE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO POTHOLE AS REQUIRED AND FIELD VERIFY LOCATION OF UTILITIES PRIOR TO PROCEEDING WITH CONSTRUCTION.

UNDERGROUND UTILITY NOTE:
YOU MUST CALL 811 NOT LESS THAN 72 HOURS BEFORE BEGINNING EXCAVATION. WHERE ANY UNDERGROUND UTILITIES MAY BE LOCATED. FAILURE TO DO SO COULD MEAN BEARING SUBSTANTIAL REPAIR COSTS (UP TO THREE TIMES THE COST OF REPAIRS TO THE SERVICE).

APPROVED
BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING
DATE _____
NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

DRAWN	RMH				
DESIGNED	RMH				
CHECKED	7/7/25 RMH				
PROJ. ENGR.					
DRAWING FILE	IL_rev1.DWG				
		DATE	REVISION	BY	APP'D

FOR:
CRP/VDC FREEMAN LOGISTICS OWNER, LLC
11411 NE 124th St., Suite 190
Kirkland, WA 98034

ROBERT MARTIN HERMAN — STATE OF WASHINGTON — 30730 — REGISTERED PROFESSIONAL ENGINEER — 7-7-25

HTE HERMAN TRAFFIC ENGINEERING, INC.
11215 Southeast 220th Place, Kent, Washington 98031
253-236-4941 tel. bob@hte-inc.com


FREEMAN LOGISTICS
CITY OF PUYALLUP/CITY OF FIFE


ILLUMINATION PLAN (CITY OF PUYALLUP)
22ND AVE. NW

IL5

SHEET OF SHEETS

PORTION OF SECTIONS 17 & 20, TOWNSHIP 20 N, RANGE 4 EAST, W.M.,
PIERCE COUNTY, WASHINGTON

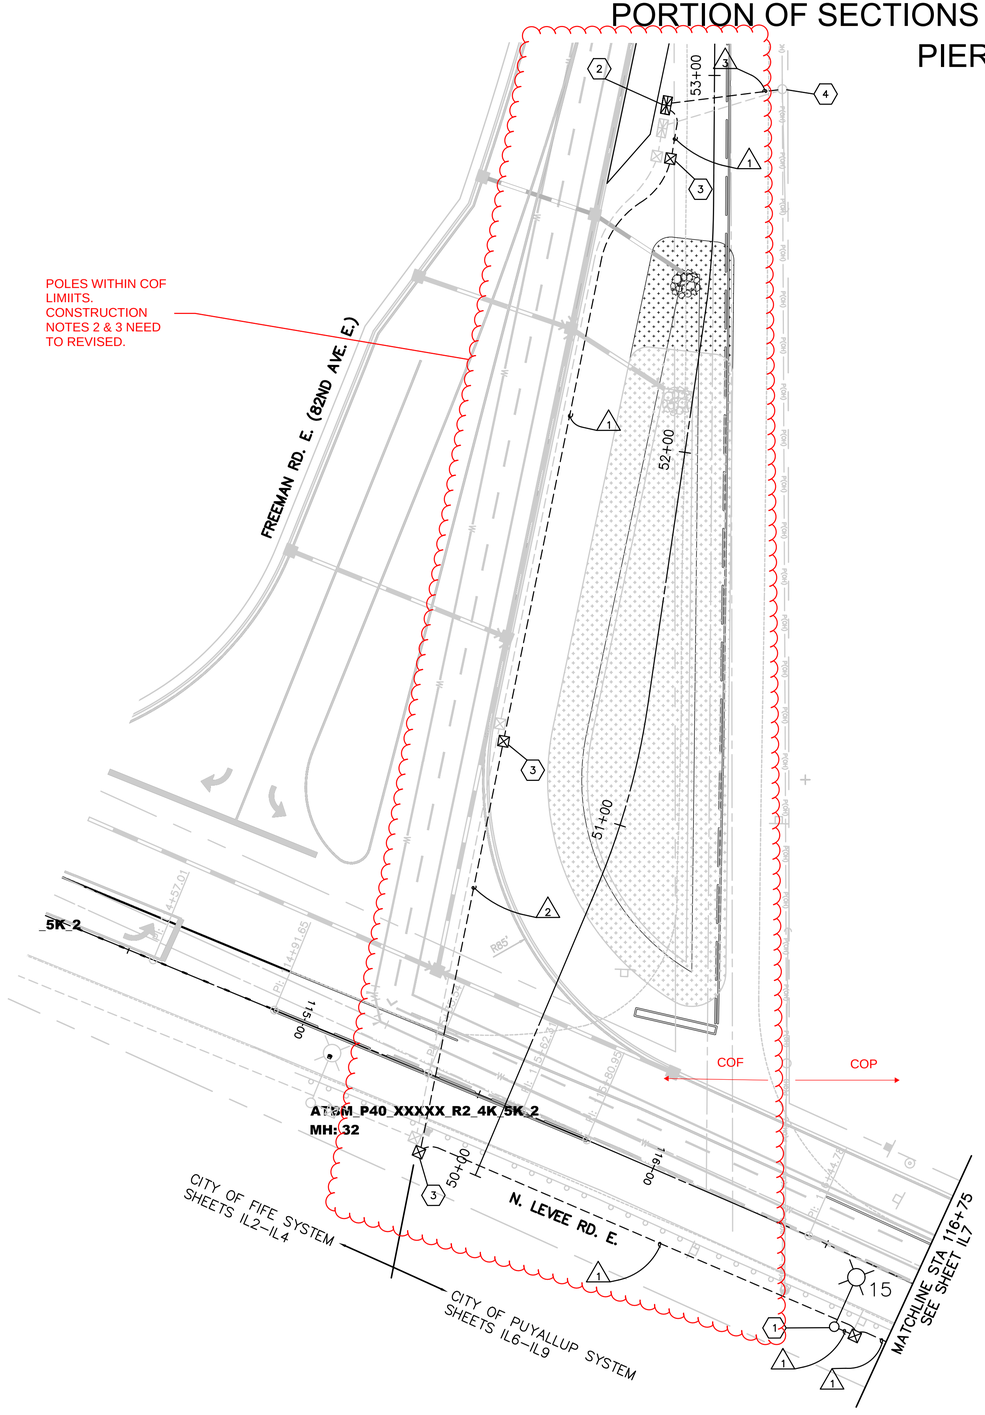



LEGEND

NEW

- LUMINAIRE
- CONDUIT (SEE WIRING SCHEDULE)
- TYPE 1 JUNCTION BOX
- ELECTRICAL SERVICE CABINET
- WIRE NOTE
- CONSTRUCTION NOTE

GENERAL NOTES

1. ALL WORK SHALL BE IN ACCORDANCE WITH THESE PLANS, CITY OF PUYALLUP CONSTRUCTION STANDARDS, WASHINGTON STATE DEPARTMENT OF TRANSPORTATION (WSDOT) STANDARD SPECIFICATIONS FOR ROAD, BRIDGE AND MUNICIPAL CONSTRUCTION, AND WSDOT STANDARD PLANS (ALL CURRENT VERSIONS).
2. THE LOCATIONS OF UTILITIES AND FEATURES SHOWN ARE APPROXIMATE AND SHALL BE VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO CONSTRUCTION START.
3. ALL WORK SHALL BE CONSISTENT WITH UTILITY AGENCY REQUIREMENTS. THE CONTRACTOR SHALL COORDINATE WITH AFFECTED UTILITY AGENCIES THROUGHOUT THE PROJECT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO UTILITIES.
4. CONDUIT AND JUNCTION BOX LOCATIONS ARE SHOWN FOR ILLUSTRATIVE PURPOSES. ACTUAL LOCATIONS SHALL BE DETERMINED BY THE CONTRACTOR IN THE FIELD WITH DIRECTION FROM THE CITY.
5. CONTRACTOR SHALL COORDINATE WITH THE CITY SIGNAL/ILLUMINATION TECHNICIAN AT 253.405.4390 PRIOR TO CONSTRUCTION.

CONSTRUCTION NOTES

CITY OF FIFE

TBD

1. INSTALL CONCRETE FOUNDATION, TYPE 1 JUNCTION BOX, STEEL LUMINAIRE STANDARD WITH 12' ARM AND 65 WATT LEOTEK FIXTURE (GCM1-60J-40K-2R-GY-105-PCR7) PER LUMINAIRE SCHEDULE AND CITY OF PUYALLUP STANDARD DETAILS 01.05.01, 02, 03, 04, 06 AND 07. INSTALL SHORTING CAP.
2. CONSTRUCT FOUNDATION AND INSTALL NEW STREET LIGHT SERVICE CABINET PER CITY OF PUYALLUP STANDARD DETAIL 01.05.05. INSTALL PHOTOCELL ON SERVICE CABINET.
3. INSTALL NEW TYPE 1 OR TYPE 2 JUNCTION BOX PER CITY OF PUYALLUP STANDARD DETAIL 01.06.01.
4. COORDINATE WITH ELECTRIC UTILITY FOR POINT OF SERVICE. ROUTE SERVICE ENTRANCE CONDUIT AND CONDUCTORS TO POINT OF SERVICE PER UTILITY REQUIREMENTS. COORDINATE WITH UTILITY FOR SERVICE CONNECTION.

CITY OF FIFE

TBD

LUMINAIRE SCHEDULE

LUM. NO.	CIRCUIT NO.	LOCATION		OFFSET (FEET)	LAMP WATTAGE	DAVIT ARM (FEET)	MOUNTING HGT. (FT.)	POLE H1 HGT. (FT.)
15	A	LEVEE RD	116+60.90	19.00 RT	65W LED	12	27	30
16	A	LEVEE RD	118+10.95	19.00 RT	65W LED	12	27	30
17	A	LEVEE RD	119+61.05	19.00 RT	65W LED	12	27	30
18	A	LEVEE RD	121+11.12	19.00 RT	65W LED	12	27	30

NOTE: INSTALL SHORTING CAPS ON ALL LUMINAIRES

WIRING SCHEDULE

RUN NO.	CONDUIT	CONDUCTORS	REMARKS
1	2" SCH 40 PVC	2-#8, 1-#8 GROUND	
2	2" SCH 80 PVC	2-#8, 1-#8 GROUND	
3	2" SCH 80 PVC	3-#2 SERVICE	

ALL PVC CONDUITS CONTAINING CONDUCTORS SHALL HAVE 1-#8 BARE GROUND WIRE

CAUTION:
LOCATION OF EXISTING UTILITIES SHOWN IS APPROXIMATE AND MAY NOT BE ACCURATE OR ALL INCLUSIVE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO POTHOLE AS REQUIRED AND FIELD VERIFY LOCATION OF UTILITIES PRIOR TO PROCEEDING WITH CONSTRUCTION.

UNDERGROUND UTILITY NOTE:
YOU MUST CALL 811 NOT LESS THAN 72 HOURS BEFORE BEGINNING EXCAVATION WHERE ANY UNDERGROUND UTILITIES MAY BE LOCATED. FAILURE TO DO SO COULD MEAN BEARING SUBSTANTIAL REPAIR COSTS (UP TO THREE TIMES THE COST OF REPAIRS TO THE SERVICE).

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

DRAWN	RMH				
DESIGNED	RMH				
CHECKED	7/7/25 RMH				
PROJ. ENGR.					
DRAWING FILE	IL_rev1.DWG				
		DATE	REVISION	BY	APP'D

FOR:
CRP/VDC FREEMAN LOGISTICS OWNER, LLC
11411 NE 124th St., Suite 190
Kirkland, WA 98034

ROBERT MARTIN HERMAN — STATE OF WASHINGTON — 30730 — REGISTERED PROFESSIONAL ENGINEER — 7-7-25

HTE HERMAN TRAFFIC ENGINEERING, INC.
11215 Southeast 220th Place, Kent, Washington 98031
253-236-4941 tel. bob@hte-inc.com


FREEMAN LOGISTICS
CITY OF PUYALLUP/CITY OF FIFE

ILLUMINATION PLAN (CITY OF PUYALLUP)
FREEMAN RD. E./N. LEVEE RD. E.

IL6

SHEET OF SHEETS

PORTION OF SECTIONS 17 & 20, TOWNSHIP 20 N, RANGE 4 EAST, W.M., PIERCE COUNTY, WASHINGTON

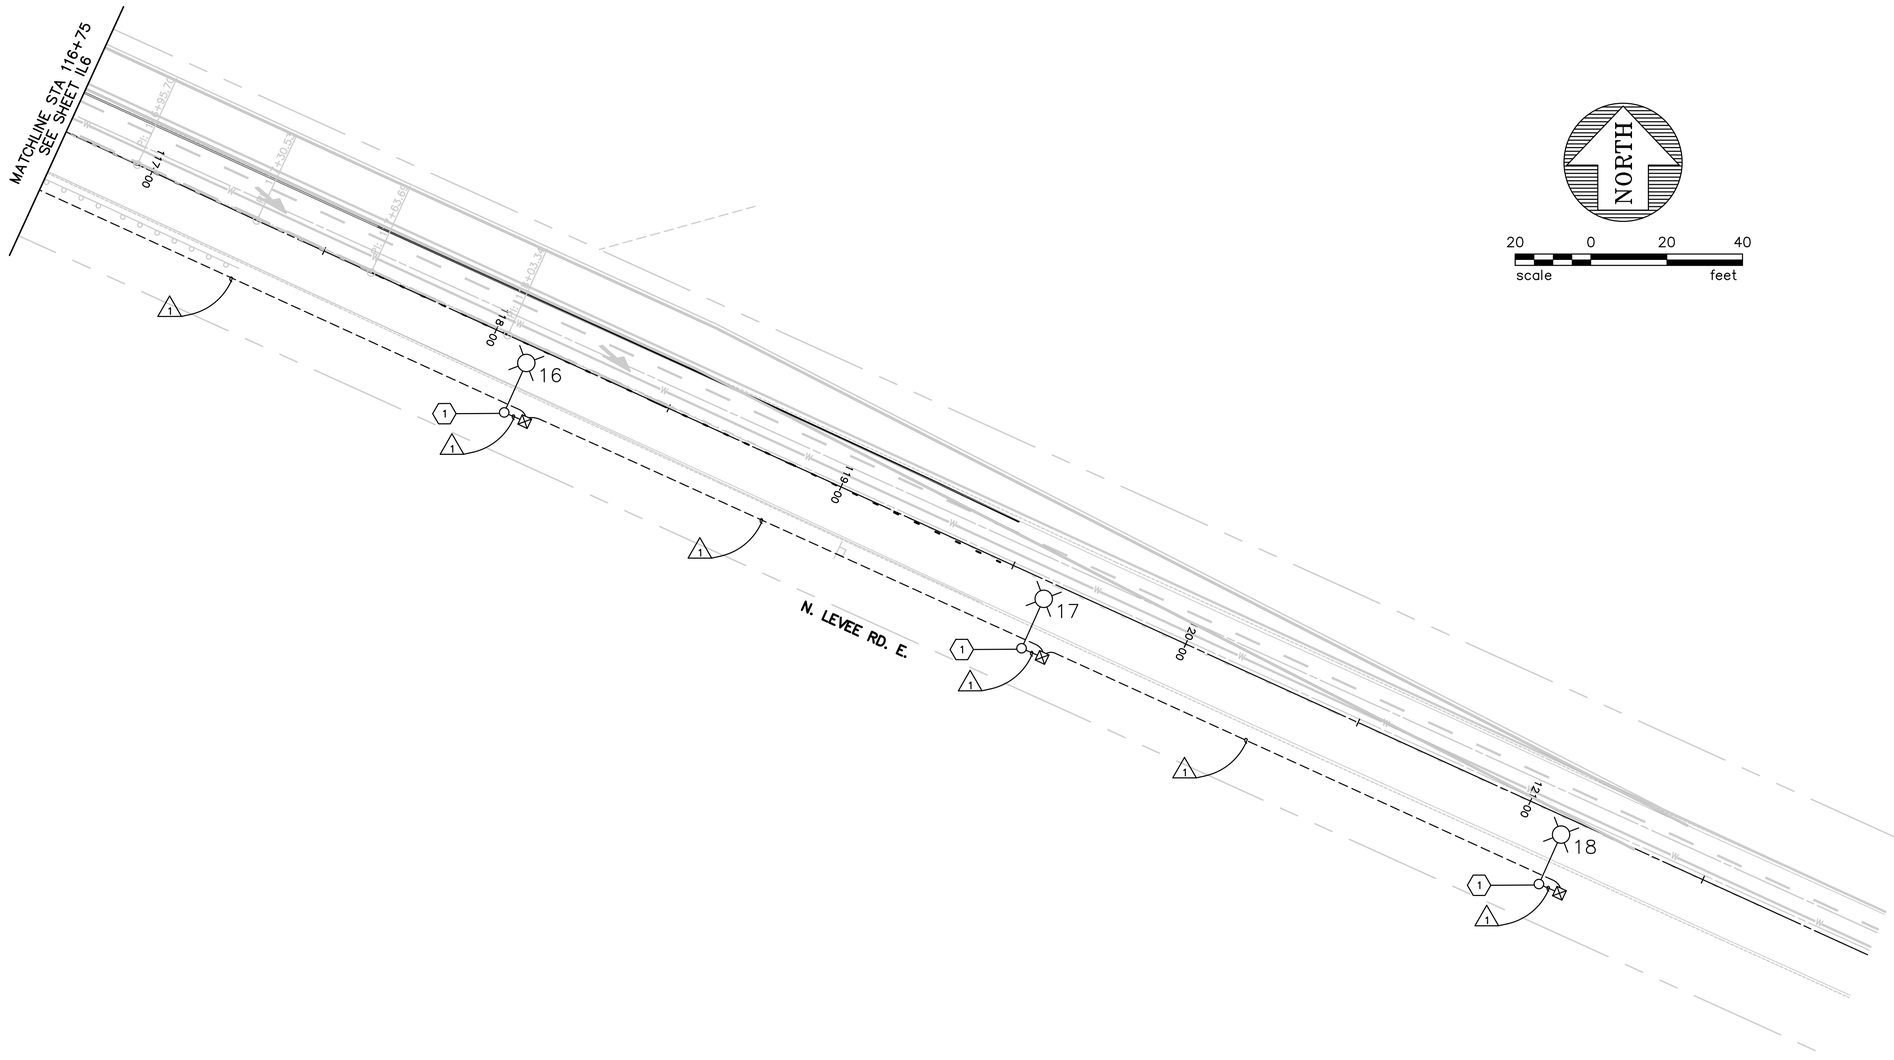

NORTH

20 0 20 40
scale feet

CAUTION:
LOCATION OF EXISTING UTILITIES SHOWN IS APPROXIMATE AND MAY NOT BE ACCURATE OR ALL INCLUSIVE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO POTHOLE AS REQUIRED AND FIELD VERIFY LOCATION OF UTILITIES PRIOR TO PROCEEDING WITH CONSTRUCTION.

UNDERGROUND UTILITY NOTE:
YOU MUST CALL 811 NOT LESS THAN 72 HOURS BEFORE BEGINNING EXCAVATION WHERE ANY UNDERGROUND UTILITIES MAY BE LOCATED. FAILURE TO DO SO COULD MEAN BEARING SUBSTANTIAL REPAIR COSTS (UP TO THREE TIMES THE COST OF REPAIRS TO THE SERVICE).

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

DRAWN RMH					
DESIGNED RMH					
CHECKED 7/7/25 RMH					
PROJ. ENGR.					
DRAWING FILE IL_rev1.DWG					
	DATE	REVISION	BY	APP'D	

FOR:
CRP/VDC FREEMAN LOGISTICS OWNER, LLC
11411 NE 124th St., Suite 190
Kirkland, WA 98034

ROBERT MARTIN HERMAN — STATE OF WASHINGTON — 36730 — REGISTERED PROFESSIONAL ENGINEER
7-7-25

HTE HERMAN TRAFFIC ENGINEERING, INC.
11215 Southeast 220th Place, Kent, Washington 98031
253-236-4941 tel. bob@hte-inc.com

FREEMAN LOGISTICS
CITY OF PUYALLUP/CITY OF FIFE

ILLUMINATION PLAN (CITY OF PUYALLUP)
FREEMAN RD. E./N. LEVEE RD. E.

IL6

SHEET
OF
SHEETS

STREET LIGHTING SPECIFICATIONS

1. 30-FOOT STEEL STREETLIGHT STANDARD

   a. DIMENSIONS

   STREETLIGHT STANDARDS SHALL PROVIDE A FIXTURE MOUNTING HEIGHT OF 30'0" PLUS OR MINUS 6" WITH A TYPICAL 12 FOOT MAST ARM WITH A THREE FOOT OVERHANG.

   BASE PLATE SHALL HAVE SLOTTED HOLES TO ACCOMMODATE 1-INCH ANCHOR BOLTS, AND 11 1/2" BOLT CIRCLE WITH MINIMUM CLEARANCE OF 1" BETWEEN BOLT AND POLE.

   HANDHOLE CENTER SHALL BE LOCATED APPROXIMATELY 12 INCHES FROM THE BASE PLATE, ROTATED 270 DEGREES FROM MAST ARM SO AS THE HANDHOLE IS LOCATED ON THE SIDE OPPOSING ONCOMING TRAFFIC.

   b. STRENGTH

   POLES SHALL MEET ALL STRENGTH REQUIREMENTS OF AASHTO FOR 90 MPH ISOTACH WHEN USED WITH A LUMINAIRE WEIGHING 48 POUNDS WITH A E.P.A. OF 1.1 SQUARE FEET. ALL ATTACHING BOLTS AND SCREWS THAT ARE NOT GALVANIZED SHALL BE STAINLESS STEEL.

   c. FINISH

   THE POLES AND ALL HARDWARE SAHALL BE HOT DIPPED GALVANIZED, MINIMUM 3 MIL THICKNESS.

   d. MAST ARM ATTACHMENT SHALL BE SECURED BY 3 BOLTS.

   e. EACH POLE SHALL HAVE HANDHOLE (WITH COVER), GROUND LUG AND REMOVABLE POLE CAP.

   f. EACH CITY POLE SHALL HAVE A BLACK 4" TO 6" LETTER C STENCILED ON ROADWAY SIDE OF POLE 18" ABOVE GRADE.

2. ANCHORAGE

   a. POLES SHALL BE ANCHORED WITH 4 BOLTS, 1"X36"X4" #SUNC WITH HOT DIPPED GALVANIZING AFTER THREADS ARE CUT. GALVANIZED AREA SHALL EXTEND FROM THREADED END FOR A MINIMUM OF 12 INCHES. BOLTS SHALL BE PROVIDED WITH 2 GALVANIZED NUTS AND FLAT WASHERS FOR LEVELING. SHIMS WILL NOT BE USED.

   b. A NON-SHRINKING GROUT SHALL BE INSTALLED WITH ONE 1/2" DRAIN HOLE UNDER THE BASE PLATE AFTER THE ENGINEER HAS APPROVED THE POLE INSTALLATION.

3. CONDUIT

   ALL CONDUIT SHALL BE BURIED A MINIMUM OF 24 INCHES DEEP. ALL ROADWAY CROSSINGS SHALL BE RIGID METALLIC OR SCHEDULE 80 PVC. CONDUIT SHALL CONFORM TO SECTION 9-29 OF WSDOT STANDARD SPECIFICATIONS. SCHEDULE 80 PVC MAY BE USED IN LOCATIONS OTHER THAN ROADWAY CROSSINGS.

CITY OF PUYALLUP — DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

STREET LIGHT SPECIFICATIONS — CITY STANDARD 01.05.01

(STR LIGHT SPECS CONTINUED)

4. JUNCTION BOXES (WHEN REQUIRED)

   JUNCTION BOXES SHALL BE INSTALLED AT LOCATIONS AS SHOWN ON THE PLANS. THEY WILL CONFORM TO WSDOT STANDARD PLAN J-40.10-02, TYPE 1. THEY SHALL BE LEVEL WITH THE SIDEWALK GRADE AND FIRMLY BEDDED TO PREVENT FUTURE SETTLING. JUNCTION BOXES ARE PREFERRED NOT TO BE INSTALLED IN THE SIDEWALK. THE COVER SHALL BE GALVANIZED AND GROUNDED. THE LETTERS "LT" SHALL BE ETCHED ON THE COVER. (SEE CITY STANDARD DETAIL NO. 01.06.01). IF THE JUNCTION BOX IS NOT IN THE SIDEWALK THEN IT SHALL HAVE A CONCRETE COLLAR. IF THE JUNCTION BOX IS IN THE SIDEWALK THEN IT SHALL HAVE A NON-SLIP SURFACE TREATMENT. SEE CITY STANDARD DETAIL NO. 01.06.01.

5. CONDUCTORS, WIRES, ETC.

   WIRE CONDUCTORS FOR UNDERGROUND FEEDER RUNS AND FOR CIRCUITRY FROM THE IN-LINE FUSE IN THE POLES TO THE JUNCTION BOX SHALL BE 600 VOLT, SINGLE CONDUCTOR STRANDED COPPER AND INSULATED WITH USE GRADE POLYVINYL CHLORIDE COMPOUND (XLP) OR APPROVED EQUAL IN ACCORDANCE WITH THE INSULATED POWER CABLE ENGINEER'S ASSOCIATION SPECIFICATION. AN #8 AWG NO. 8 GREEN INSULATED STRANDED COPPER WIRE WILL BE RUN TO THE SERVICE GROUND LUG ON EACH POLE. FEEDERS SHALL BE SIZED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE. WIRES INSIDE THE POLE BETWEEN BALLAST AND IN-LINE FUSES SHALL BE ROME 2C AWG 19 STRANDED POLE AND BRACKET WIRE OR APPROVED EQUAL. SPLICES WILL BE ALLOWED IN JUNCTION BOXES AND POLE BASES ONLY. NO MORE THAN 2 CONDUITS WILL BE ALLOWED INSIDE THE STREET POLE.

6. FUSES

   LUMINAIRE FUSING AND ELECTRICAL CONNECTIONS AT LIGHT STANDARD BASES SHALL CONFORM TO SECTION 9-29.7 OF THE STATE OF WASHINGTON STANDARD SPECIFICATIONS AND AS SHOWN ON THE UNIFORM LUMINAIRE WIRING DETAIL IN THE APPENDIX. IN-LINE FUSE HOLDERS SHALL BE: SEC MODEL 1791-SF WITH FNM-5 FUSES OR APPROVED EQUAL. (REFER TO CITY STANDARD DETAIL NO. 01.06.01)

7. LUMINAIRES AND LAMPS

   RESIDENTIAL STREETS AND NEIGHBORHOOD COLLECTORS:
   LEOTEK LED GC1-40E-MV-NW-2-530 (67 WATT LED)

   ARTERIALS AND COMMERCIAL COLLECTORS:
   GE EVOLVE LED ERS2-E-0-HX-EX-5-40 (130 WATT LED)

   THE CITY WILL ENERGIZE THE STREET LIGHTS WHEN A HOME IS OCCUPIED ADJACENT TO A STREET LIGHT OR IMMEDIATELY ACROSS THE STREET. AT THE DEVELOPER'S REQUEST, STREET LIGHTS MAY BE ENERGIZED PRIOR TO OCCUPANCY OF HOMES. HOWEVER, THE DEVELOPER OR BUILDER SHALL ASSUME FULL RESPONSIBILITY FOR ELECTRICAL POWER COSTS AND REPAIR COSTS DUE TO VANDALISM, THEFT, OR CONSTRUCTION.

8. SAFE WIRING LABELS

   THE CONTRACTOR IS ADVISED THAT SAFE WIRING LABELS REQUIRED BY LABOR AND INDUSTRIES SHALL APPLY ON THIS PROJECT. (ELECTRICAL INSPECTION STICKER)

9. GUARANTEE


   THE CONTRACTOR SHALL SURRENDER TO THE CITY OF PUYALLUP ANY GUARANTEE OR WARRANTY ACQUIRED BY HIM AS A NORMAL TRADE PRACTICE IN CONNECTION WITH THE PURCHASE OF ANY MATERIALS OR ITEMS USED IN THE CONSTRUCTION OF THE ILLUMINATION.

10. LOCATION

    SEE CITY STANDARD SECTION 01.01 ROADWAY DESIGN.

CITY OF PUYALLUP — DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS


STREET LIGHT SPECIFICATIONS (CONT.) — CITY STANDARD 01.05.02

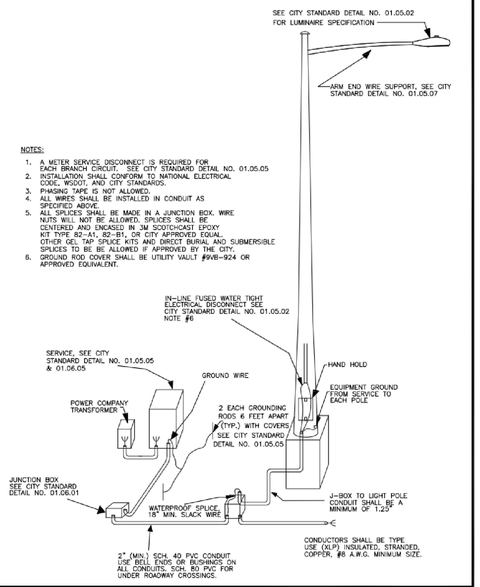

NOTES:
1. A METER SERVICE DISCONNECT IS REQUIRED FOR EACH BRANCH CIRCUIT. SEE CITY STANDARD DETAIL NO. 01.05.05
2. INSTALLATION SHALL CONFORM TO NATIONAL ELECTRICAL CODE, WSDOT, AND CITY STANDARDS.
3. PHASING TAPE IS NOT ALLOWED.
4. ALL WIRES SHALL BE INSTALLED IN CONDUIT AS SPECIFIED ABOVE.
5. ALL SPLICES SHALL BE MADE IN A JUNCTION BOX. WIRE NUTS WILL NOT BE ALLOWED. SPLICES SHALL BE CENTERED AND ENCASED IN 3M SCOTCHCAST EPOXY KIT TYPE 82-A1, 82-B1, OR CITY APPROVED EQUAL. OTHER GEL TAP SPLICE KITS AND DIRECT BURIAL AND SUBMERSIBLE SPLICES TO BE BE ALLOWED IF APPROVED BY THE CITY.
6. GROUND ROD COVER SHALL BE UTILITY VAULT #9VB-924 OR APPROVED EQUIVALENT.

CITY OF PUYALLUP — DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

TYPICAL STREET LIGHT INSTALLATION — CITY STANDARD 01.05.03

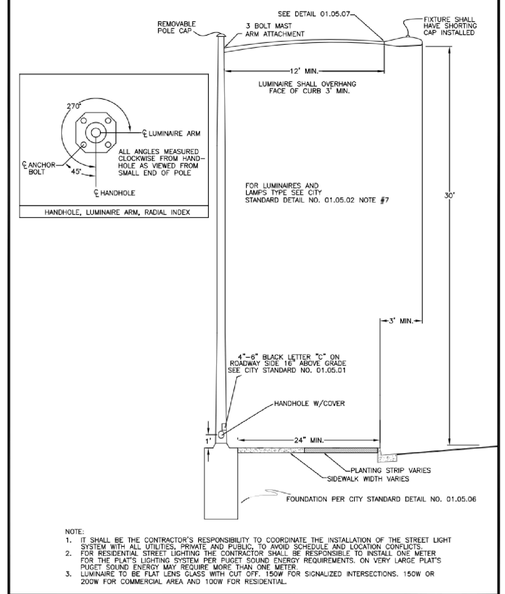


HANDHOLE, LUMINAIRE ARM, RADIAL INDEX

NOTE:
1. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO COORDINATE THE INSTALLATION OF THE STREET LIGHT SYSTEM WITH ALL UTILITIES, PRIVATE AND PUBLIC, TO AVOID SCHEDULE AND LOCATION CONFLICTS.
2. FOR RESIDENTIAL STREET LIGHTING THE CONTRACTOR SHALL BE RESPONSIBLE TO INSTALL ONE METER FOR THE PLAT'S LIGHTING SYSTEM PER PUGET SOUND ENERGY REQUIREMENTS. ON VERY LARGE PLAT'S PUGET SOUND ENERGY MAY REQUIRE MORE THAN ONE METER.
3. LUMINAIRE TO BE FLAT LENS GLASS WITH CUT OFF. 150W FOR SIGNALIZED INTERSECTIONS. 150W OR 200W FOR COMMERCIAL AREA AND 100W FOR RESIDENTIAL.


CITY OF PUYALLUP — DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

STREET LIGHT — CITY STANDARD 01.05.04

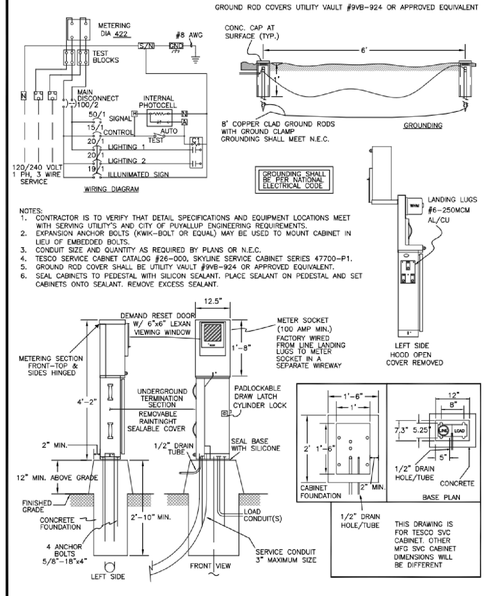

CITY OF PUYALLUP — DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

STREET LIGHT SERVICE METER CABINET FOUNDATION — CITY STANDARD 01.05.05

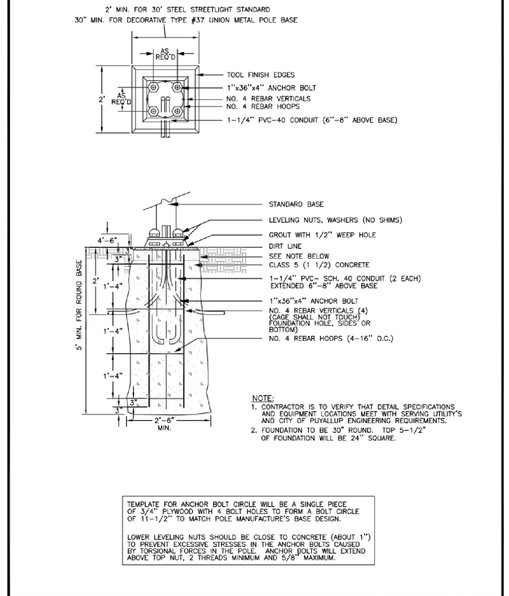


NOTE:
1. CONTRACTOR IS TO VERIFY THAT DETAIL SPECIFICATIONS AND EQUIPMENT LOCATIONS MEET WITH SERVING UTILITY'S AND CITY OF PUYALLUP ENGINEERING REQUIREMENTS.
2. FOUNDATION TO BE 30" ROUND. TOP 5-1/2" OF FOUNDATION WILL BE 24" SQUARE.

TEMPLATE FOR ANCHOR BOLT CIRCLE WILL BE A SINGLE PIECE OF 3/4" PLYWOOD WITH 4 BOLT HOLES TO FORM A BOLT CIRCLE OF 11-1/2" TO MATCH POLE MANUFACTURE'S BASE DESIGN.

LOWER LEVELING NUTS SHOULD BE CLOSE TO CONCRETE (ABOUT 1") TO PREVENT EXCESSIVE STRESSES IN THE ANCHOR BOLTS CAUSED BY TORSIONAL FORCES IN THE POLE. ANCHOR BOLTS WILL EXTEND ABOVE TOP NUT, 2 THREADS MINIMUM AND 5/8" MAXIMUM.


CITY OF PUYALLUP — DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

CONCRETE STREETLIGHT FOUNDATION TYPICAL — CITY STANDARD 01.05.06

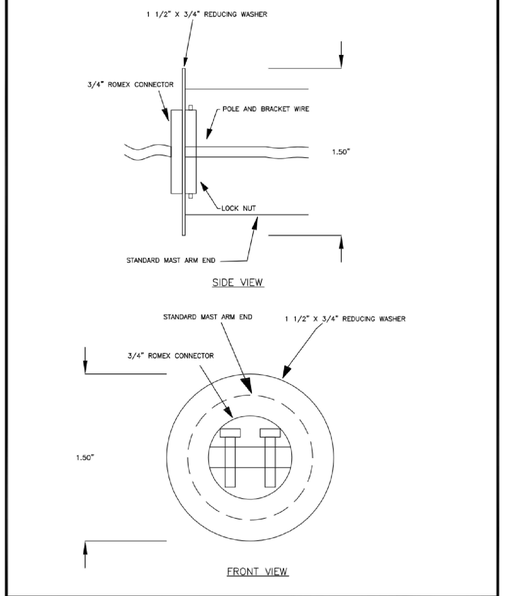

CITY OF PUYALLUP — DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

STREET LIGHT POLE AND BRACKET WIRE SUPPORT AT ARM END — CITY STANDARD 01.05.07

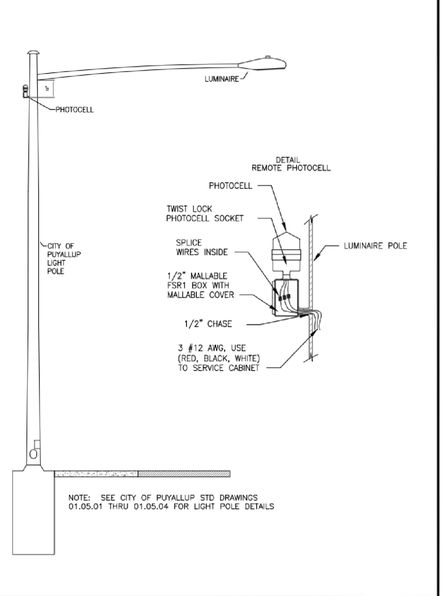

NOTE: SEE CITY OF PUYALLUP STD DRAWINGS 01.05.01 THRU 01.05.04 FOR LIGHT POLE DETAILS

CITY OF PUYALLUP — DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

REMOTE PHOTOCELL — CITY STANDARD 01.05.10

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

DRAWN	RMH				
DESIGNED	RMH				
CHECKED	7/7/25 RMH				
PROJ. ENGR.					
DRAWING FILE	IL_rev1.DWG				
		DATE	REVISION	BY	APP'D

FOR:
CRP/VDC FREEMAN LOGISTICS OWNER, LLC
11411 NE 124th St., Suite 190
Kirkland, WA 98034

ROBERT MARTIN HERMAN — STATE OF WASHINGTON — 30730 — REGISTERED PROFESSIONAL ENGINEER — 7-7-25


HTE HERMAN TRAFFIC ENGINEERING, INC.
11215 Southeast 220th Place, Kent, Washington 98031
253-236-4941 tel. bob@hte-inc.com

FREEMAN LOGISTICS
CITY OF PUYALLUP/CITY OF FIFE

CITY OF PUYALLUP
ILLUMINATION DETAILS

IL8

SHEET
OF
SHEETS

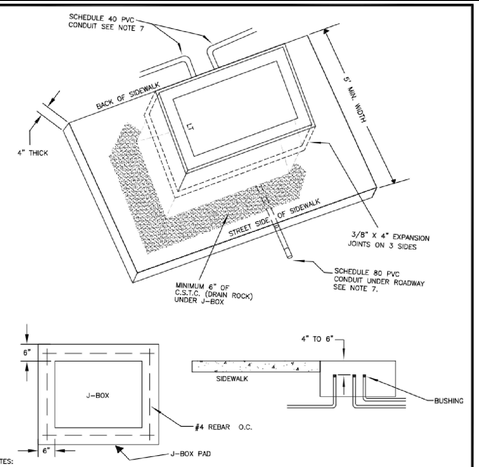

NOTES:

1. SEE W.S.D.O.T. STANDARD PLAN J-40.10-03 FOR J-BOX TYPE AND SIZE.
2. ALL LIDS SHALL BE GALVANIZED STEEL AND MARKED WITH AN "LT" OR "TS" PER W.S.D.O.T. STANDARD PLAN J-40.10-03. NON-SLIP SURFACE TREATMENT SHALL BE MEBAC1 OR SlipNOT #3.
3. TYPE III SHALL BE DUAL HINGED
4. IF NO SIDEWALK EXISTS, A CONCRETE COLLAR SHALL BE CONSTRUCTED 6" THICK, 6" WIDE, COMPLETELY SURROUNDING THE J-BOX WITH ONE #4 REBAR ON CENTER EACH SIDE AND TIED AT CORNERS. CLASS 5 (1 1/2) CONCRETE SHALL BE USED. BY PERMISSION, COLLAR MAY ENCOMPASS JUNCTION BOX AND STREET LIGHT. PREFERRED LOCATION OF JUNCTION BOX SHOULD NOT BE IN THE SIDEWALK, BUT RATHER AT THE BACK OF SIDEWALK WITH 3-SIDED COLLAR.
5. CONDUIT RUNS SHALL NOT EXCEED 195 FEET BETWEEN JUNCTION BOXES.
6. JUNCTION BOX SHALL BE LOCATED WITHIN 10 FEET OF EACH LUNIMAIRE POLE AND AT ROAD CROSSING.
7. CONDUIT MATERIAL SHALL BE AS SPECIFIED IN WSDOT STANDARD SPECIFICATION 8-20.3(5) OR AS MODIFIED ON SPECIAL PROVISIONS.
8. STREET LIGHT JUNCTION BOXES SHALL BE WELDED SHUT, 2"-2" LONG WELDS MIN., IMMEDIATELY AFTER L & I AND CITY INSPECTIONS TO HELP PREVENT WIRE THEFT. OTHER THEFT PREVENTION METHODS MAY BE USED IF APPROVED BY THE CITY.

CITY OF PUYALLUP
DEVELOPMENT ENGINEERING and PUBLIC WORKS DEPARTMENTS

JUNCTION BOX

DRAWN BY	CHECKED BY	APPROVED BY	REVISED BY	CITY STANDARD
DAVE KOSLOWSKI	LINDA LIAN	WILLIAM WARNE	LINDA LIAN	
FILE NAME		DATE APPROVED	DATE REVISED	SCALE
J:\PROJ\COMMON\SITE\CITY\2009-25_SITE\14-00\01.06.01		8/11/2009	11/18/2014	NTS

01.06.01

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

DRAWN RMH				
DESIGNED RMH				
CHECKED 7/7/25 RMH				
PROJ. ENGR.				
DRAWING FILE IL_rev1.DWG				
	DATE	REVISION	BY	APP'D

FOR:
CRP/VDC FREEMAN LOGISTICS OWNER, LLC
11411 NE 124th St., Suite 190
Kirkland, WA 98034

ROBERT MARTIN HERMAN — STATE OF WASHINGTON — 30730 — REGISTERED PROFESSIONAL ENGINEER
7-7-25

HTE HERMAN TRAFFIC ENGINEERING, INC.
11215 Southeast 220th Place, Kent, Washington 98031
253-236-4941 tel. bob@hte-inc.com

FREEMAN LOGISTICS
CITY OF PUYALLUP/CITY OF FIFE

CITY OF PUYALLUP
ILLUMINATION DETAILS

IL9

SHEET
OF
SHEETS


PORTION OF SECTION 20, TOWNSHIP 20 N, RANGE 4 EAST, W.M.,
CITY OF FIFE, WASHINGTON

ENGINEER'S REVIEW

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☑ FOR INFORMATION ONLY

The City's review is not a confirmation of any dimension or quantities shown in the plans and will not relieve the Developer or Engineer from responsibility for plan errors. No changes shall be made to the plans except with the consent of the City Engineer. If construction has not commenced within a reasonable period of the approval date, plans will require re-approval by the City.

BY tosborne DATE 9/10/2025

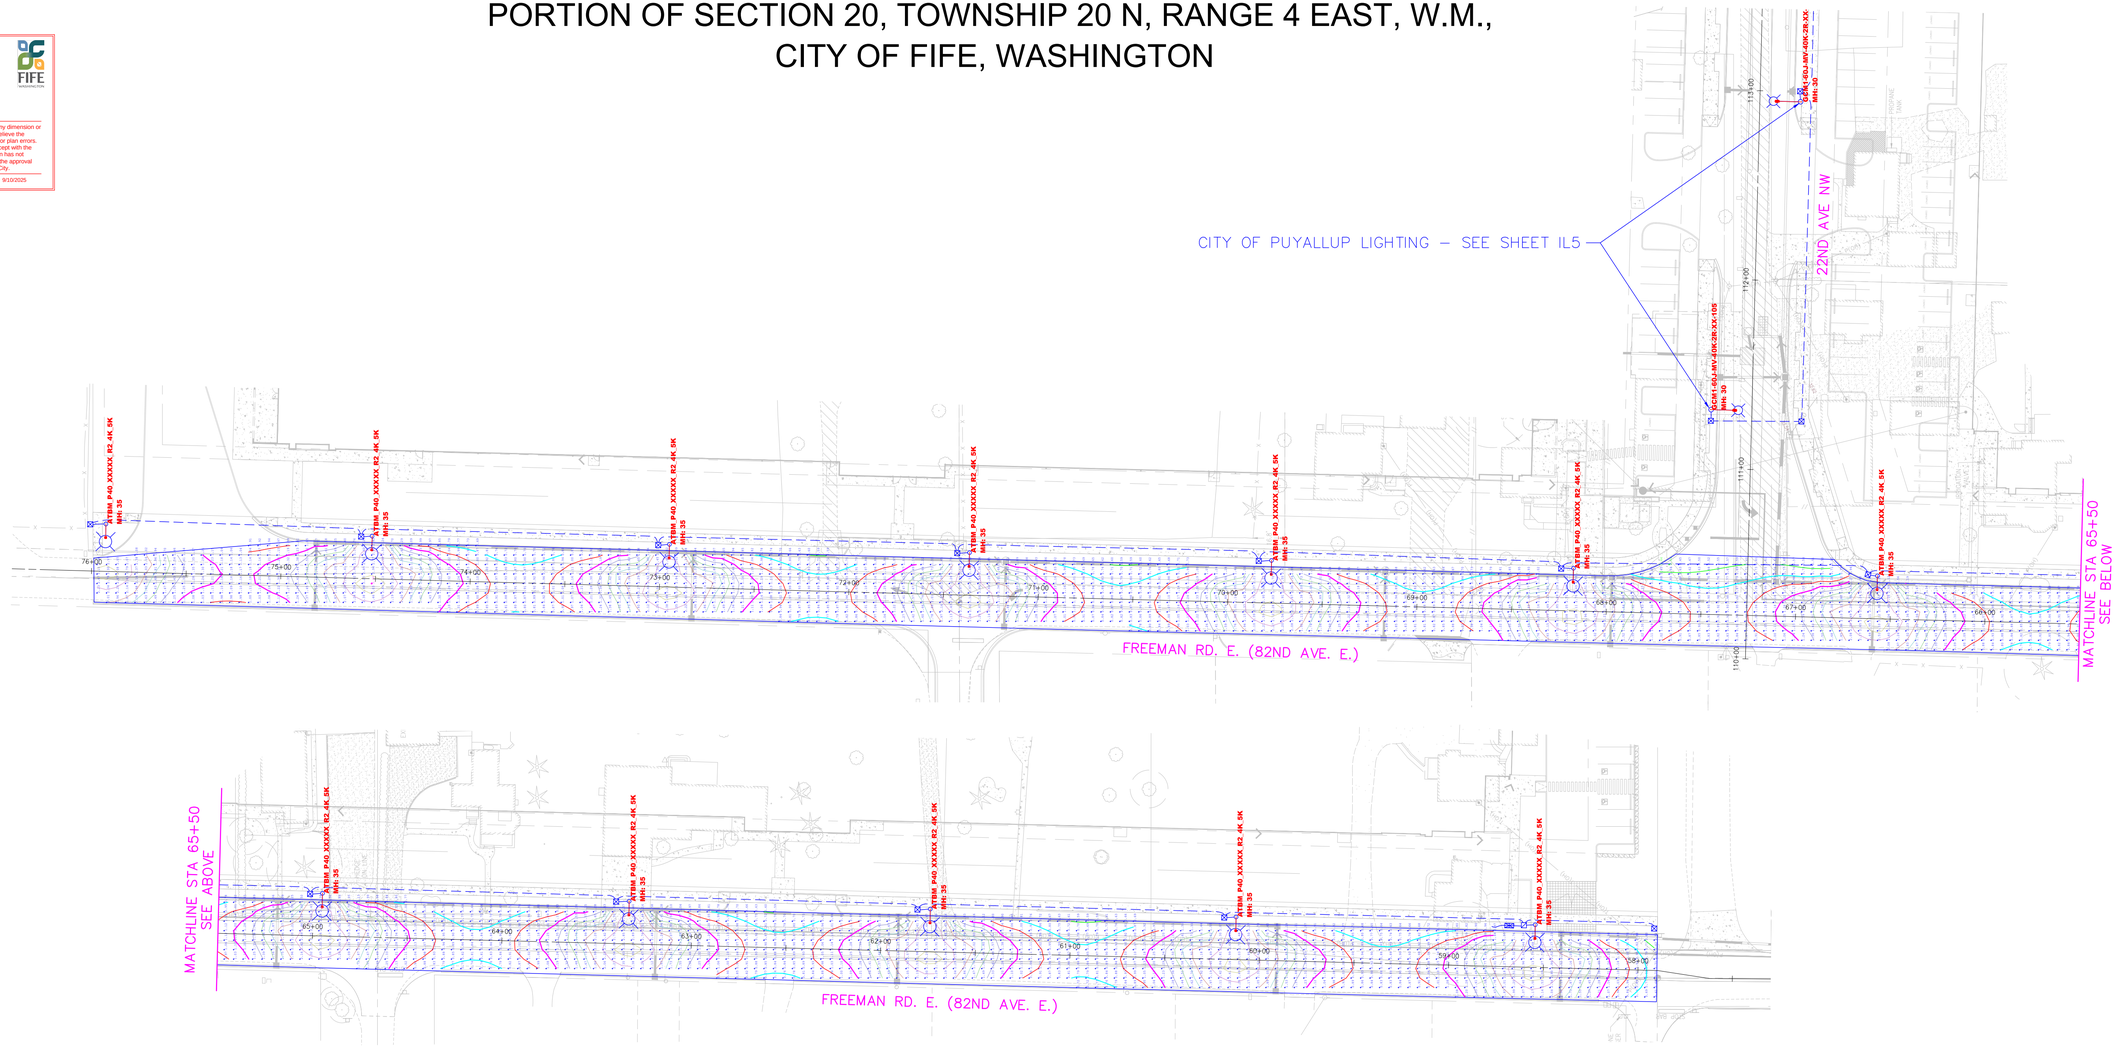



Luminaire Schedule							
Symbol	Qty	Label	LLF	Luminaire Lumens	Luminaire Watts	Mounting Height (ft.)	Description
	2	GCM1-60J-MV-40K-2R-XX-105	0.900	10395	65	30	30' MH 12' Arm (City of Puyallup)
	12	ATBM_P40_XXXXX_R2_4K_5K	0.900	17494	135	35	35' MH 6' Arm (City of Fife)

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
Freeman Rd	Illuminance	Fc	1.42	3.36	0.44	3.23	7.64

COF ILLUMINATION LEVEL
MINIMUM IS 0.6 FOOT-CANDLES
(FMC 12.20.090 C.).

DRAWN	RMH					
DESIGNED	RMH					
CHECKED	7/7/25 RMH					
PROJ. ENGR.						
DRAWING FILE	IL_rev1.DWG					
		DATE	REVISION	BY	APP'D	

FOR:
CRP/VDC FREEMAN LOGISTICS OWNER, LLC
11411 NE 124th St., Suite 190
Kirkland, WA 98034

ROBERT MARTIN HERMAN — STATE OF WASHINGTON — 19736 — REGISTERED PROFESSIONAL ENGINEER
7-7-25

HTE HERMAN TRAFFIC ENGINEERING, INC.
11215 Southeast 220th Place, Kent, Washington 98031
253-236-4941 tel. bob@hte-inc.com


FREEMAN LOGISTICS
CITY OF PUYALLUP/CITY OF FIFE

ILLUMINATION CALCULATIONS
FREEMAN RD. E.

ILC1

SHEET 1 OF 2 SHEETS

PORTION OF SECTION 20, TOWNSHIP 20 N, RANGE 4 EAST, W.M.,
CITY OF FIFE, WASHINGTON

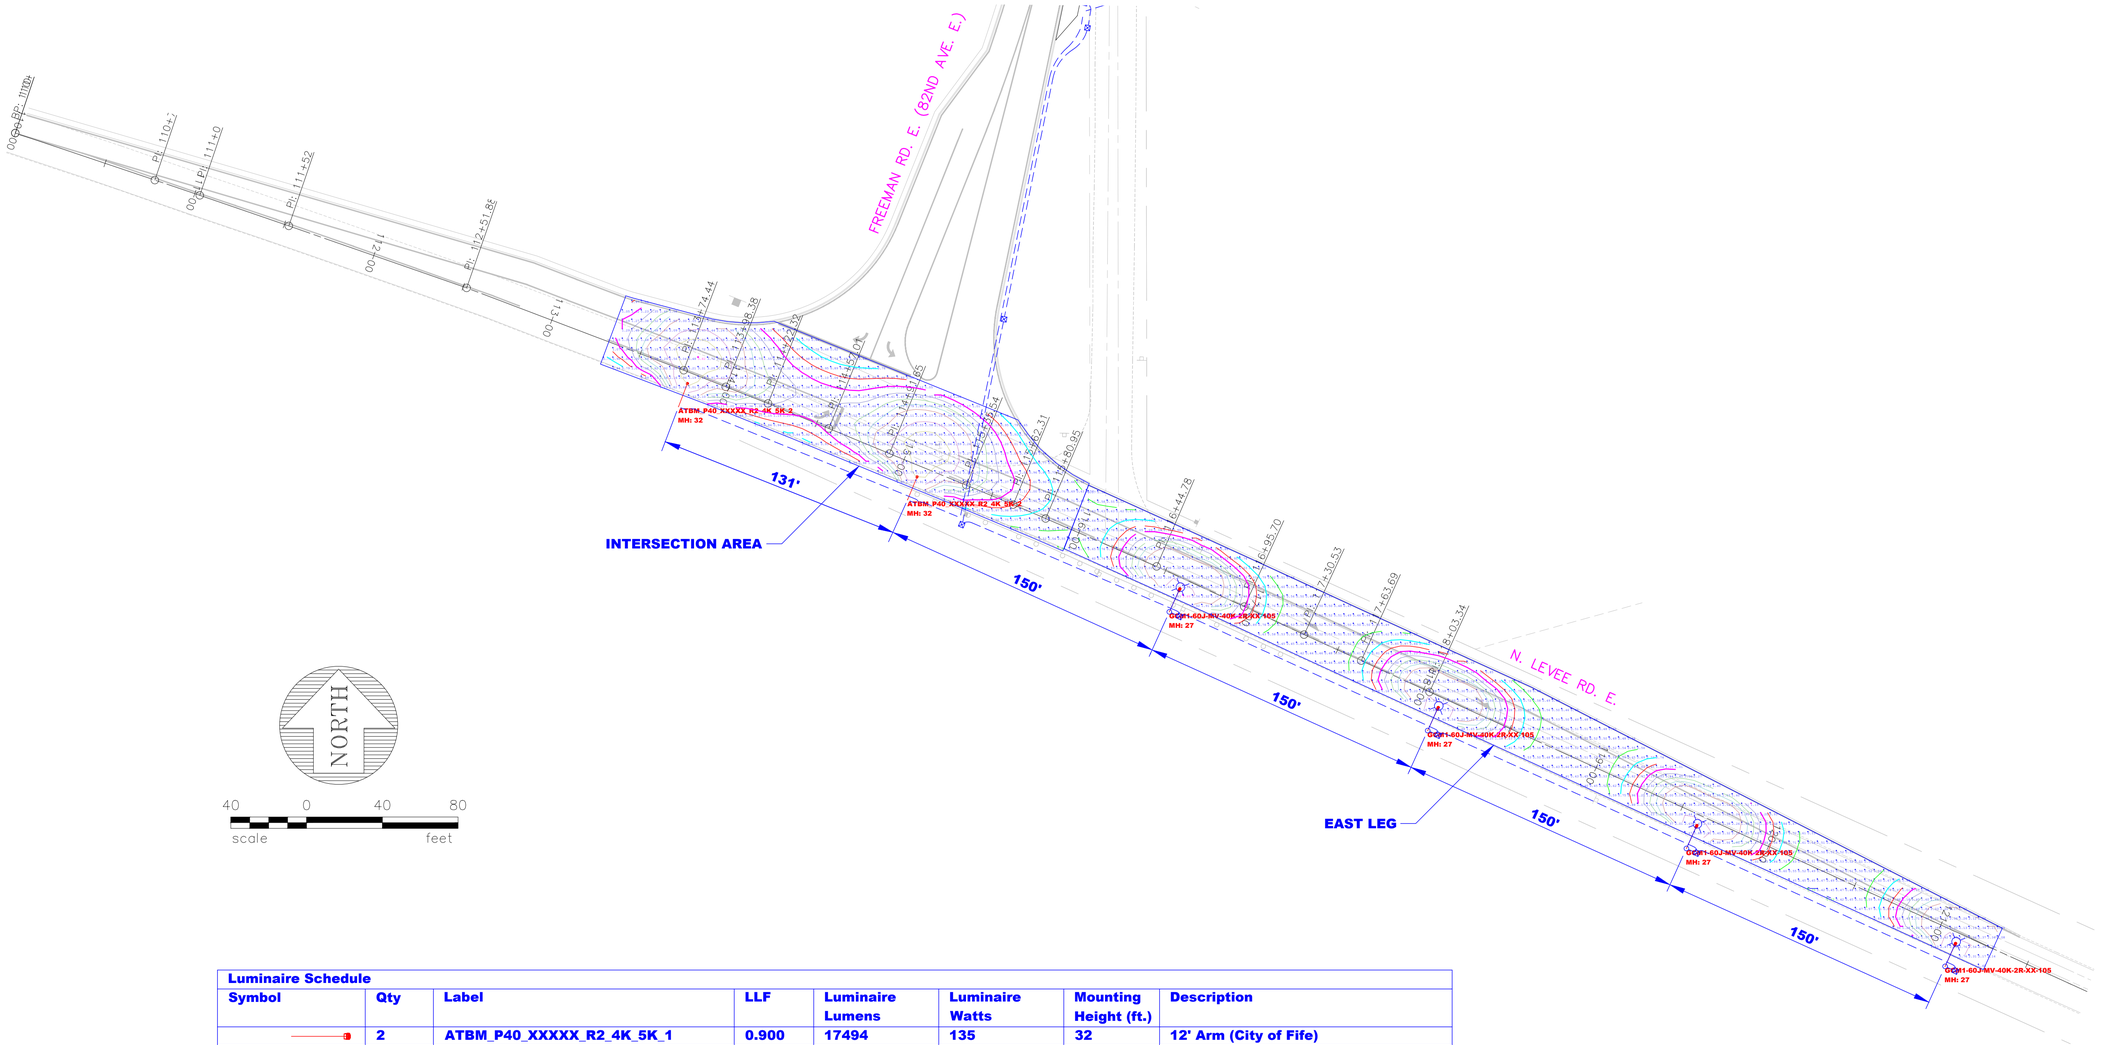

Luminaire Schedule							
Symbol	Qty	Label	LLF	Luminaire Lumens	Luminaire Watts	Mounting Height (ft.)	Description
	2	ATBM_P40_XXXXX_R2_4K_5K_1	0.900	17494	135	32	12' Arm (City of Fife)
	4	GCM1-60J-MV-40K-2R-XX-105	0.900	10395	65	27	12' Arm (City of Puyallup)

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
Freeman Rd E at N Levee Rd E - Intersection Area	Illuminance	Fc	1.58	3.82	0.46	3.43	8.30
Freeman Rd E at N Levee Rd E - East Leg	Illuminance	Fc	1.19	2.89	0.39	3.05	7.41

COF ILLUMINATION LEVEL
AVERAGE IS 1.2 FOOT-CANDLES
(FMC 12.20.090 C.).

COF ILLUMINATION LEVEL
MINIMUM IS 0.6 FOOT-CANDLES
(FMC 12.20.090 C.).

DRAWN	RMH
DESIGNED	RMH
CHECKED	7/7/25 RMH
PROJ. ENGR.	
DRAWING FILE	IL_rev1.DWG

DATE	REVISION	BY	APP'D

FOR:

CRP/VDC FREEMAN LOGISTICS OWNER, LLC
11411 NE 124th St., Suite 190
Kirkland, WA 98034

ROBERT MARTIN LEMAN — STATE OF WASHINGTON — 30730 — REGISTERED PROFESSIONAL ENGINEER
7-7-25

HTE HERMAN TRAFFIC ENGINEERING, INC.
11215 Southeast 220th Place, Kent, Washington 98031
253-236-4941 tel. bob@hte-inc.com

FREEMAN LOGISTICS
CITY OF PUYALLUP/CITY OF FIFE

ILLUMINATION CALCULATIONS
FREEMAN RD. E./N. LEVEE RD. E.

ILC2

SHEET 2 OF 2 SHEETS

BARGHAUSEN

ENGINEER'S REVIEW

FIFE WASHINGTON

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☑ FOR INFORMATION ONLY

The City's review is not a confirmation of any dimension or quantities shown in the plans and will not relieve the Developer or Engineer from responsibility for plan errors. No changes shall be made to the plans except with the consent of the City Engineer. If construction has not commenced within a reasonable period of the approval date, plans will require re-approval by the City.

BY tosborne DATE 9/10/2025



PRELIMINARY STORMWATER SITE PLAN

FREEMAN LOGISTICS

PREPARED BY
JASON MCARDEL, P.E.

PREPARED FOR
VECTOR DEVELOPMENT COMPANY

CLIENT ADDRESS
11411 NE 124TH ST, SUITE 190
KIRKLAND, WA 98034

SITE ADDRESS	PROJECT NO.	DATE	JURISDICTION
22ND AVE NW AND 82ND AVE E, PUYALLUP, WA	21585	07/14/2025	CITY OF PUYALLUP CITY OF FIFE

PROJECT ENGINEER'S CERTIFICATION

"I hereby state that this Preliminary Stormwater Site Plan for Freeman Logistics has been prepared by me or under my supervision and meets the standards of care and expertise that is usual and customary in this community for professional engineers. I understand that the City of Puyallup and City of Fife does not and will not assume liability for the sufficiency, suitability, or performance of drainage facilities prepared by me."

Jason McArdel, PE, Senior Civil Project Manager

TABLE OF CONTENTS

1.0 ANALYSIS OF THE MINIMUM REQUIREMENTS

2.0 PROJECT OVERVIEW

3.0 EXISTING CONDITIONS SUMMARY

4.0 OFF-SITE ANALYSIS REPORT

5.0 PERMANENT STORMWATER CONTROL PLAN

6.0 SPECIAL REPORTS AND STUDIES

7.0 OTHER PERMITS

8.0 CONSTRUCTION STORMWATER POLLUTION PREVENTION PLAN

9.0 OPERATION AND MAINTENANCE MANUAL

Tab 1.0

1.0 ANALYSIS OF THE MINIMUM REQUIREMENTS

1.0 ANALYSIS OF THE MINIMUM REQUIREMENTS

This is a new development project where Minimum Requirements #1 through #9 are applicable. Please see the applicable flow charts to determine the minimum requirements.

Minimum Requirement No. 1: Preparation of Stormwater Site Plan.

Response: This Stormwater Site Plan prepared for the project meets the requirements of Minimum Requirement No. 1.

Minimum Requirement No. 2: Construction Stormwater Pollution Prevention Plan.

Response: A Construction Stormwater Pollution Prevention Plan is provided within section 8.0 of this report.

Minimum Requirement No. 3: Source Control of Pollution.

Response: Available and reasonable Source Control BMPs will be applied to this project for the type of source control pollution being produced on this project site.

Minimum Requirement No. 4: Preservation of Natural Drainage Systems and Outfalls.

Response: The project site is predominantly flat farmland with very slight gradient. Most of the site drains toward the northwest corner and outfalls through an existing 12" concrete culvert under Freeman Road. The downstream from this point includes approximately 1,500 feet of open channel, followed by several thousand feet of tight-line conveyance to the west toward the Fife oxbow wetland. The proposed development will alter the outfall from the site, pumping stormwater directly to the existing storm system along N Levee Road. From here, the stormwater runoff is ultimately conveyed to the Puyallup River. The Puyallup River receiving water is the same with either discharge path. The change of discharge location is necessary due to the project inability to obtain discharge rights from landowners along the natural discharge route.

Minimum Requirement No. 5: On-Site Stormwater Management.

Response: On-Site Stormwater Management is achieved by collecting storm water through catch basins and routing to one of three underground detention facilities. Stormwater receives Enhanced treatment through proprietary vaults. After treatment, stormwater is pumped to the proposed outfall, within an existing structure approximately 3/4 miles from the project site. Frontage improvement runoff from a separate offsite basin south of 19th Ave NW is mitigated using a biofiltration/infiltration pond which is sized for full infiltration up to the 100-year storm. Please see Section 5.0 Permanent Stormwater Control Plan for the full narrative describing feasibility of LID BMPs.

Minimum Requirement No. 6: Runoff Treatment.

Response: The project is a commercial development which requires Enhanced water quality treatment. Devices meeting Ecology's Enhanced treatment standard are designed to mitigate target surface runoff of the project, including onsite and frontage improvements.

Minimum Requirement No. 7: Flow Control.

Response: The natural discharge location flows to vegetated streams and wetland areas downstream of the site. Discharges to the natural discharge location must meet the Flow Control Performance Standard. Due to property rights challenges outside of the developer's

THIS SHOULD BE DETEMINED DURING THE DESIGN PHASE OF THE PROJECT.

control, the natural discharge cannot be utilized. The proposed discharge route is discussed in MR #4 above. This route uses entirely manmade conveyance elements and is therefore exempt from flow control. Due to capacity constraints in the existing downstream conveyance system, the project is currently designed using flow control facilities. Additional study may allow for a reduced volume of detention and will be determined during preparation of construction permits.

The current proposal uses detention vaults to store and release stormwater for the onsite and frontage improvements to attenuate flows. Offsite improvements south of 19th Ave NW include a biofiltration/infiltration pond which provides full infiltration of target surface area for this separate basin. Please see Section 5.0 Permanent Stormwater Control Plan for additional details and calculations.

Minimum Requirement No. 8: Wetlands Protection.


Response: There is a single wetland onsite in the north end. The wetland is only 1,218 square feet in area. Compensatory mitigation is proposed onsite which will allow the filling of this wetland. Additionally, there is an adjacent creek and wetlands offsite to the northeast with buffers extending onsite. Proposed mitigation includes buffer enhancement within the impacted site area. Refer to the Critical Areas report by Anchor QEA in Section 6.0.

Minimum Requirement No. 9: Operation and Maintenance.

Response: An Operations and Maintenance Manual is provided within this stormwater site plan. See section 9.0 for more details.

MINIMUM REQUIREMENT FLOW CHARTS

Figure I-3.1: Flow Chart for Determining Requirements for New Development

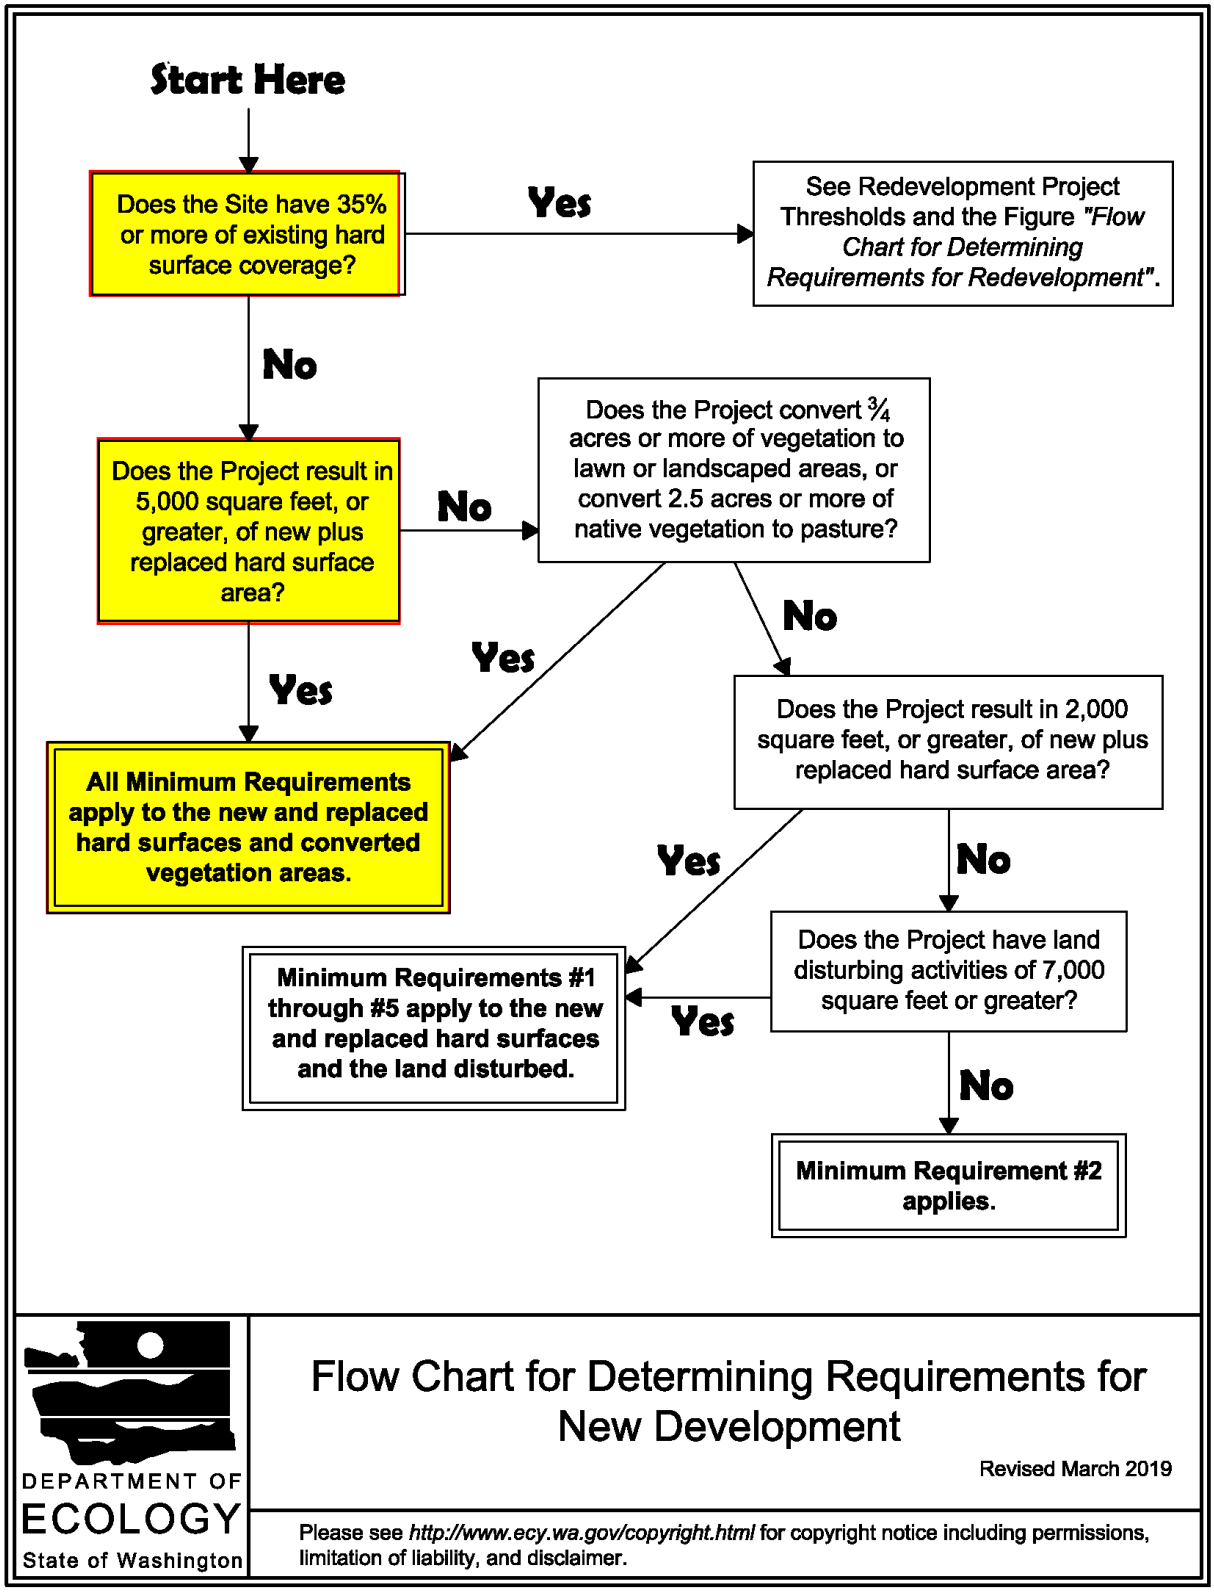

Tab 2.0

2.0 PROJECT OVERVIEW

2.0 PROJECT OVERVIEW

Freeman Logistics is an approximately 24.05-acre development located in the northeast and southeast corners of the 22nd Ave NW and Freeman Road East (also known as 82nd Ave E) intersection, Puyallup, Washington, within a portion of Section 17, Township 20 North, Range 4 East, and a portion of section 20, Township 20 North, Range 4 East, Willamette Meridian, City of Puyallup, Pierce County, Washington. The site was originally comprised of 15 parcels. A lot-combination process has been completed to consolidate the land into 2 parcels. Frontage improvements and dedications are required along Freeman Road East on the west side of the property and along 22nd Ave NW which divides the property into north and south halves. Offsite road improvements are proposed along Freeman Road East between 19th Ave NW and North Levee Road East. Additionally, an alternative utility routing is shown on the preliminary plans extending west on 48th Street East. If the alternative routing is selected, improvements would also be required along this street. Please see the attached Vicinity Map on the following pages of the report.

Under existing conditions, this site is lightly developed, consisting of farmland and scattered single-family houses. Housing is concentrated in the middle of the site and along the southwestern border. The site is very flat and does not have well-defined drainage. No manmade drainage structures exist within the site interior. There exists a shallow 12" concrete culvert in the northwest corner where stormwater is conveyed offsite under Freeman Road to the west. Per the geotechnical report prepared for the project, the soil on site is alluvial type loamy to sandy loam. The soil has minimal infiltration potential. A high-water table is present onsite, approximately 2-9 feet below the existing grade, varying with the season and location. Vegetation is predominantly pasture in the north, prior crop use in the south, plus a few scattered trees and lawn adjacent the single-family homes. The frontage roads, Freeman Road East and 22nd Ave NW, are narrow two-lane roads with no curbing. The north end of Freeman Road includes a roadside ditch along the west side which receives drainage from the site via the 12" culvert.

The developed site will include two commercial warehouse-type buildings with dock high loading, associated parking, storm drainage facilities, utilities, and frontage improvements.

Frontage improvements along Freeman Road East and 22nd Ave NW include widening the road pavement and installing a two-way left turn lane, curb & gutter, planter strip, sidewalk, street trees, lighting, and stormwater facilities per city standards. Right-of-way dedication along Freeman Road is proposed to create a 35-ft wide half street on the project side.

Offsite road improvements on Freeman Road East, south of 19th Ave NW, include road widening, realignment, channelization, addition of turn lanes, lighting and stormwater infrastructure to support a completely revised intersection at N Levee Road E. The revisions are required to support the added truck traffic to and from the development and to meet sight distance requirements.

In total the improvements onsite plus frontage area is 26.30 acres. The impervious coverage after development will be approximately 80%.

Summary of Land Coverage Areas

Land Use Category	Area (square feet)	Area (acres)
New Asphalt/Concrete	480,999	11.04
New buildings	504,023	11.57
New landscape/lawn	160,660	3.69
Total	1,145,682	26.30

This stormwater site plan is prepared in accordance with the 2019 Department of Ecology Stormwater Manual for Western Washington, as adopted by the Cities of Puyallup and Fife. The parcel area and adjacent frontage improvements are designed using catch basins and conveyance pipes which direct storm runoff to underground detention facilities. The flow control standard will be achieved for all target surfaces. Stormwater treatment is via proprietary water quality facilities which meet the Enhanced treatment standard. Mitigated flows will be conveyed to a lift station which will pump stormwater to a discharge point offsite to the southeast. Stormwater runoff from the offsite Freeman Road and Levee Road intersection improvements is mitigated separately. This runoff is directed to an open biofiltration/infiltration pond which provides treatment and full infiltration into the native soils. See Section 5.0 for more information.

VICINITY MAP



REFERENCE: MapQuest (2022)

Scale:
Horizontal: **N.T.S.** Vertical: **N/A**

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

For:
Freeman Road Logistics
Fife, Washington


Title:
VICINITY MAP

Job Number
21585

DATE: 09/01/22

P:\21000s\21585\exhibit\graphics\21585 vmap.cdr

ASSESSOR MAP

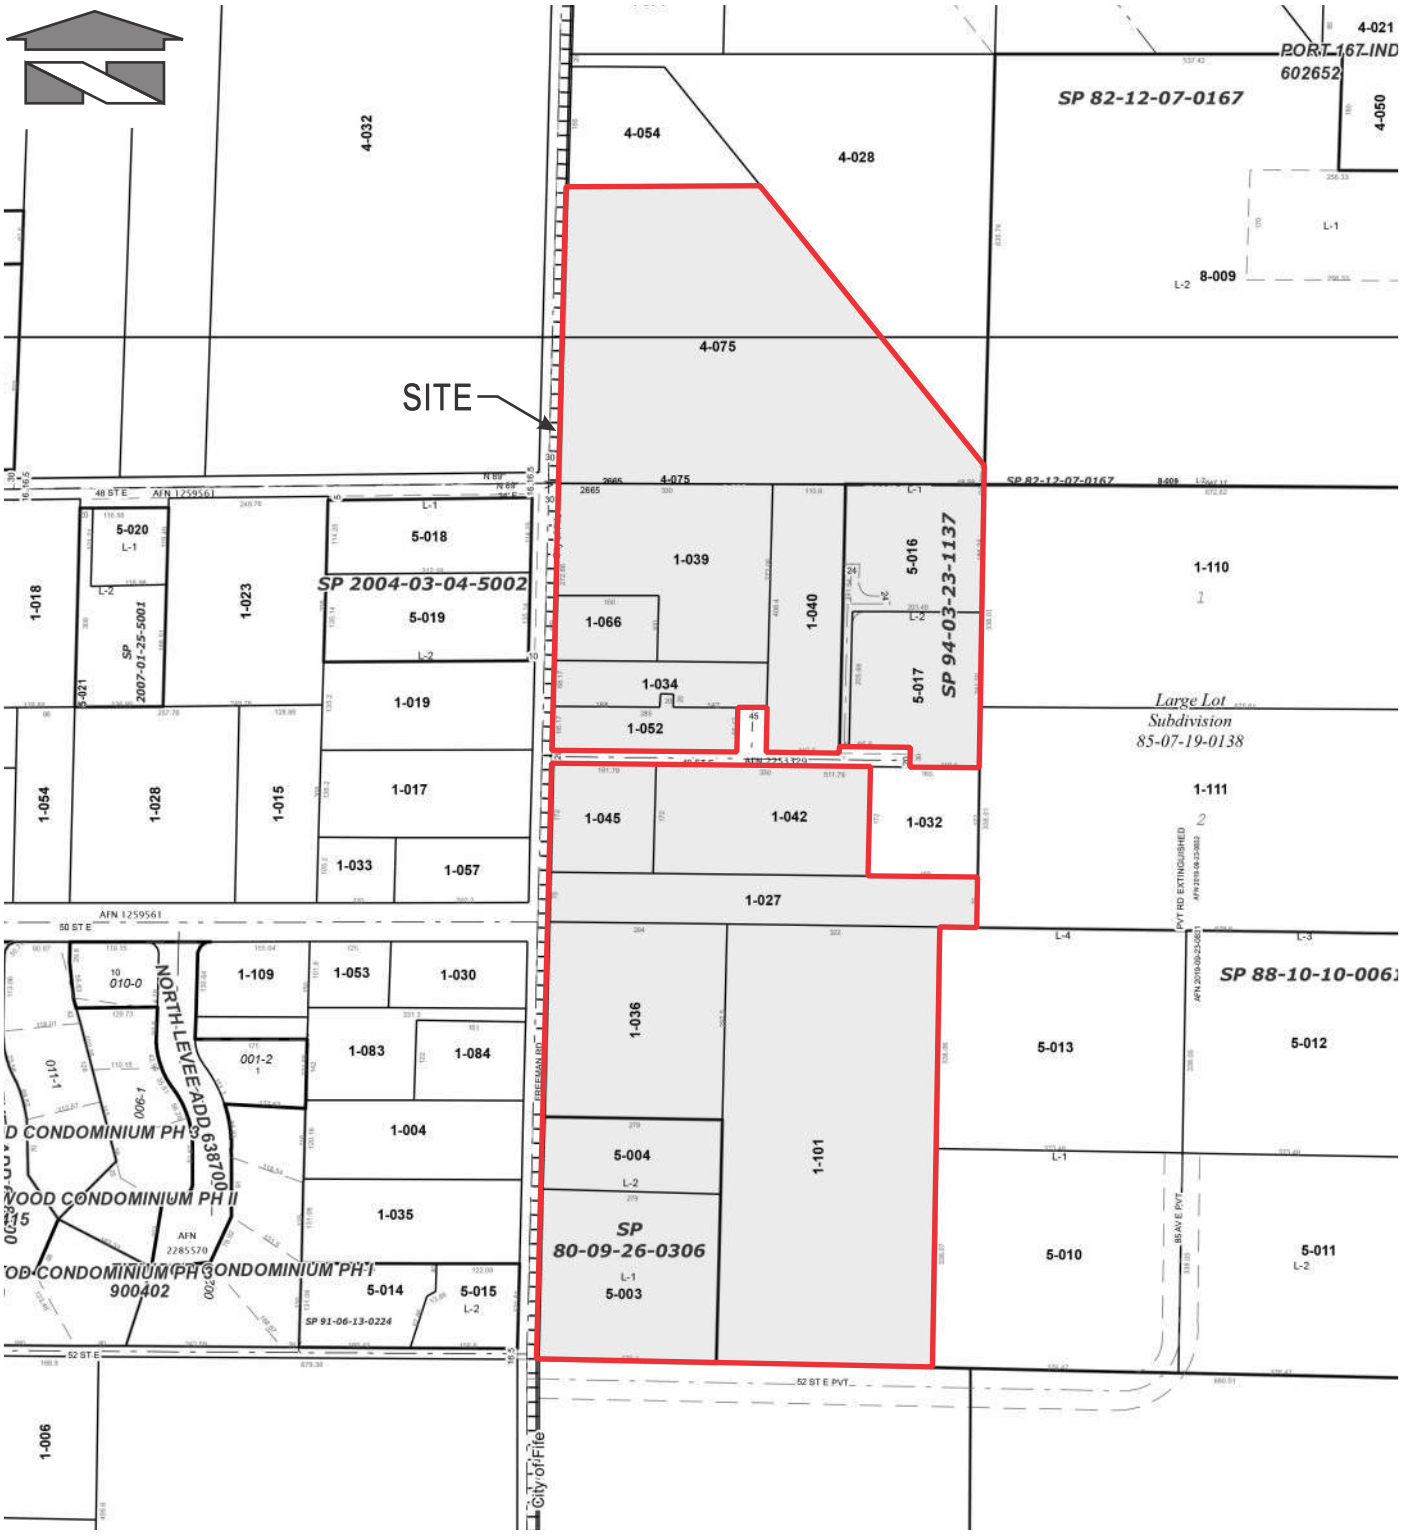

REFERENCE: Pierce County Department of Assessments (Feb. 2021)

Scale:
Horizontal: **N.T.S.** Vertical: **N/A**

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

For:
Freeman Road Logistics
Fife, Washington


Job Number
21585

Title:
ASSESSOR MAP

DATE: 09/01/22

P:\21000s\21585\exhibit\graphics\21585 amap.cdr

FEMA MAP

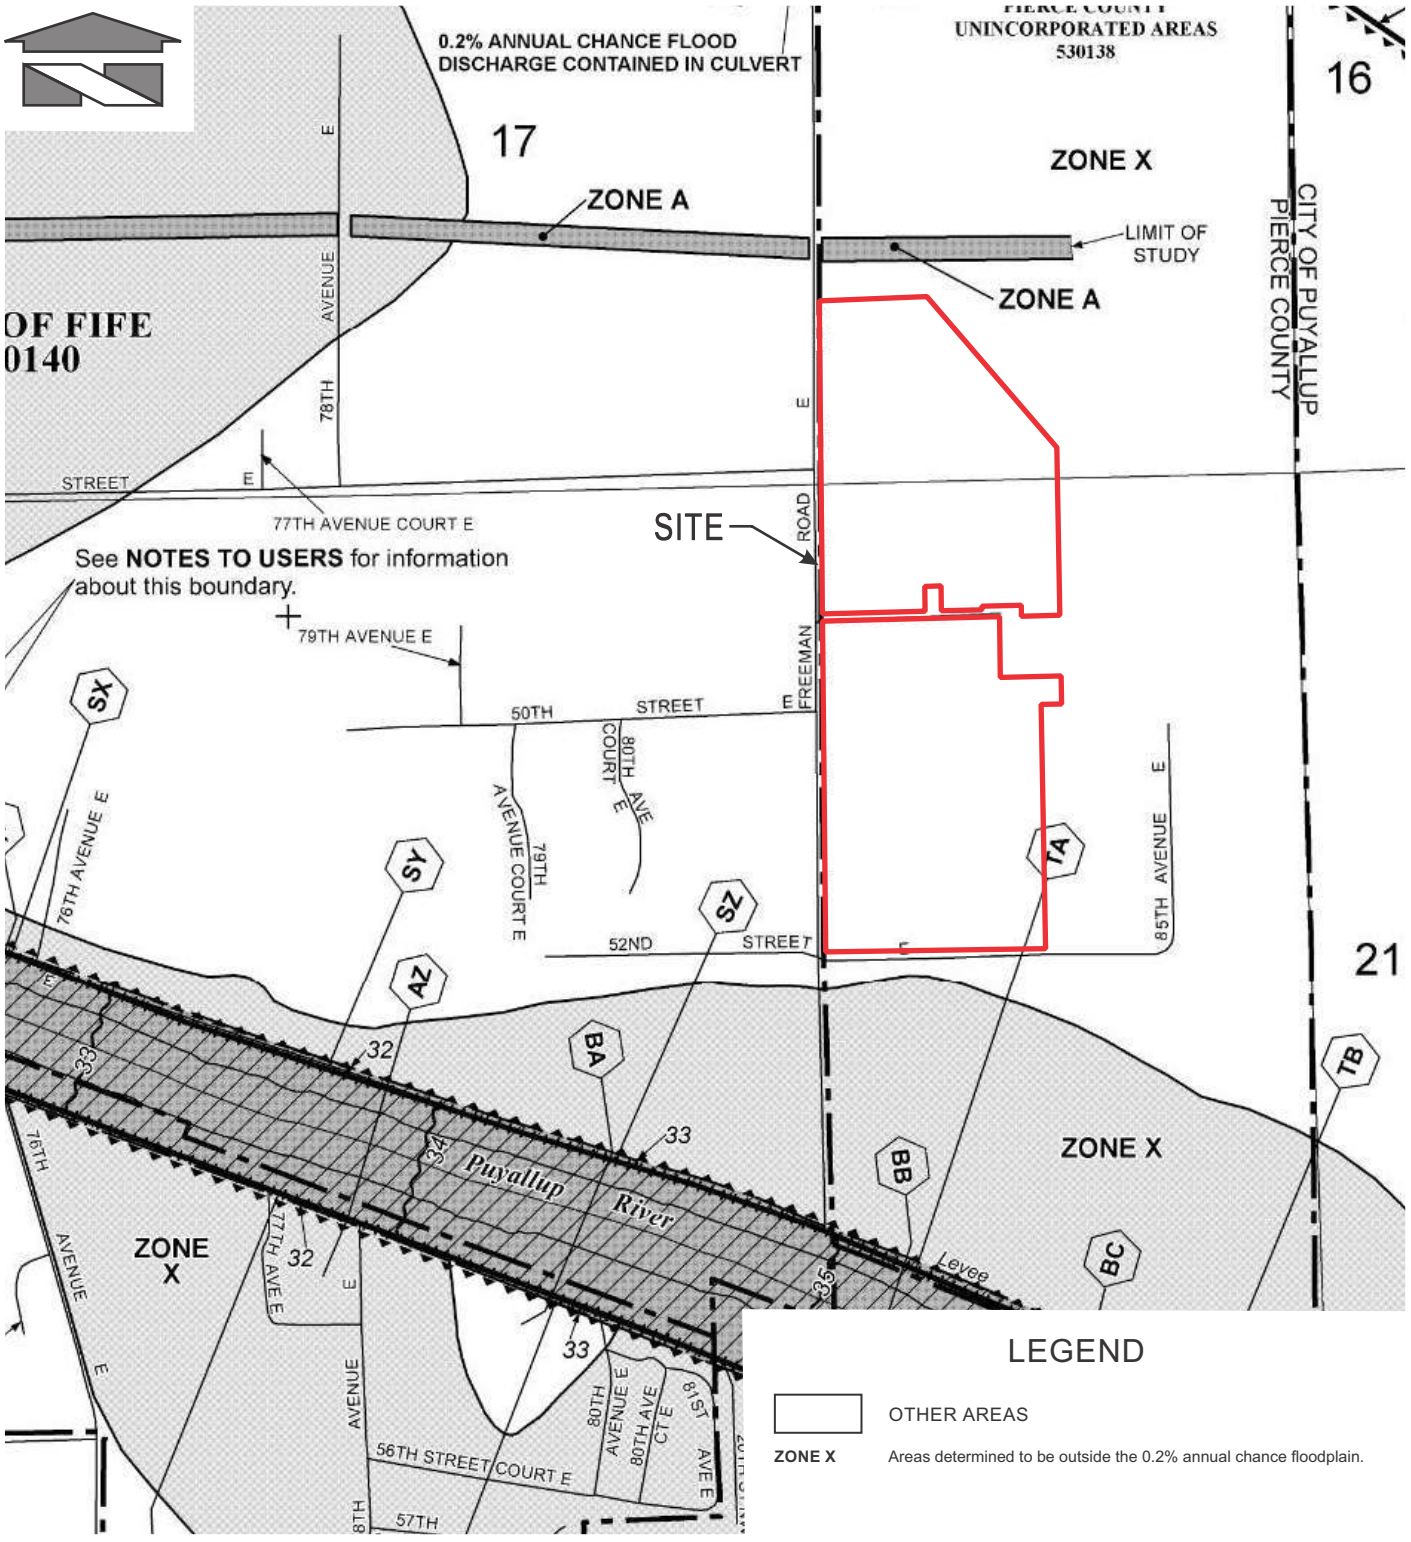

LEGEND

OTHER AREAS

ZONE X Areas determined to be outside the 0.2% annual chance floodplain.

REFERENCE: Federal Emergency Management Agency (Portion of Map 53053C0329E, March 2017)

Scale:

Horizontal: ***N.T.S.*** *Vertical:* ***N/A***

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

For:

Freeman Road Logistics
Fife, Washington

Title:

FEMA MAP

Job Number

21585

DATE: 09/01/22

P:\21000s\21585\exhibit\graphics\21585 fema.cdr

SOILS MAP



REFERENCE: USDA, Natural Resources Conservation Service

LEGEND:	HSG
42A = Sultan silt loam	C/D
31A = Puyallup fine sandy loam	A

Scale:
Horizontal: **N.T.S.** Vertical: **N/A**

Barghausen
Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

For:
Freeman Road Logistics
Fife, Washington


Job Number
21585

Title:
SOIL SURVEY MAP

DATE: 09/01/22

P:\21000s\21585\exhibit\graphics\21585 soil.cdr

SENSITIVE AREAS MAP

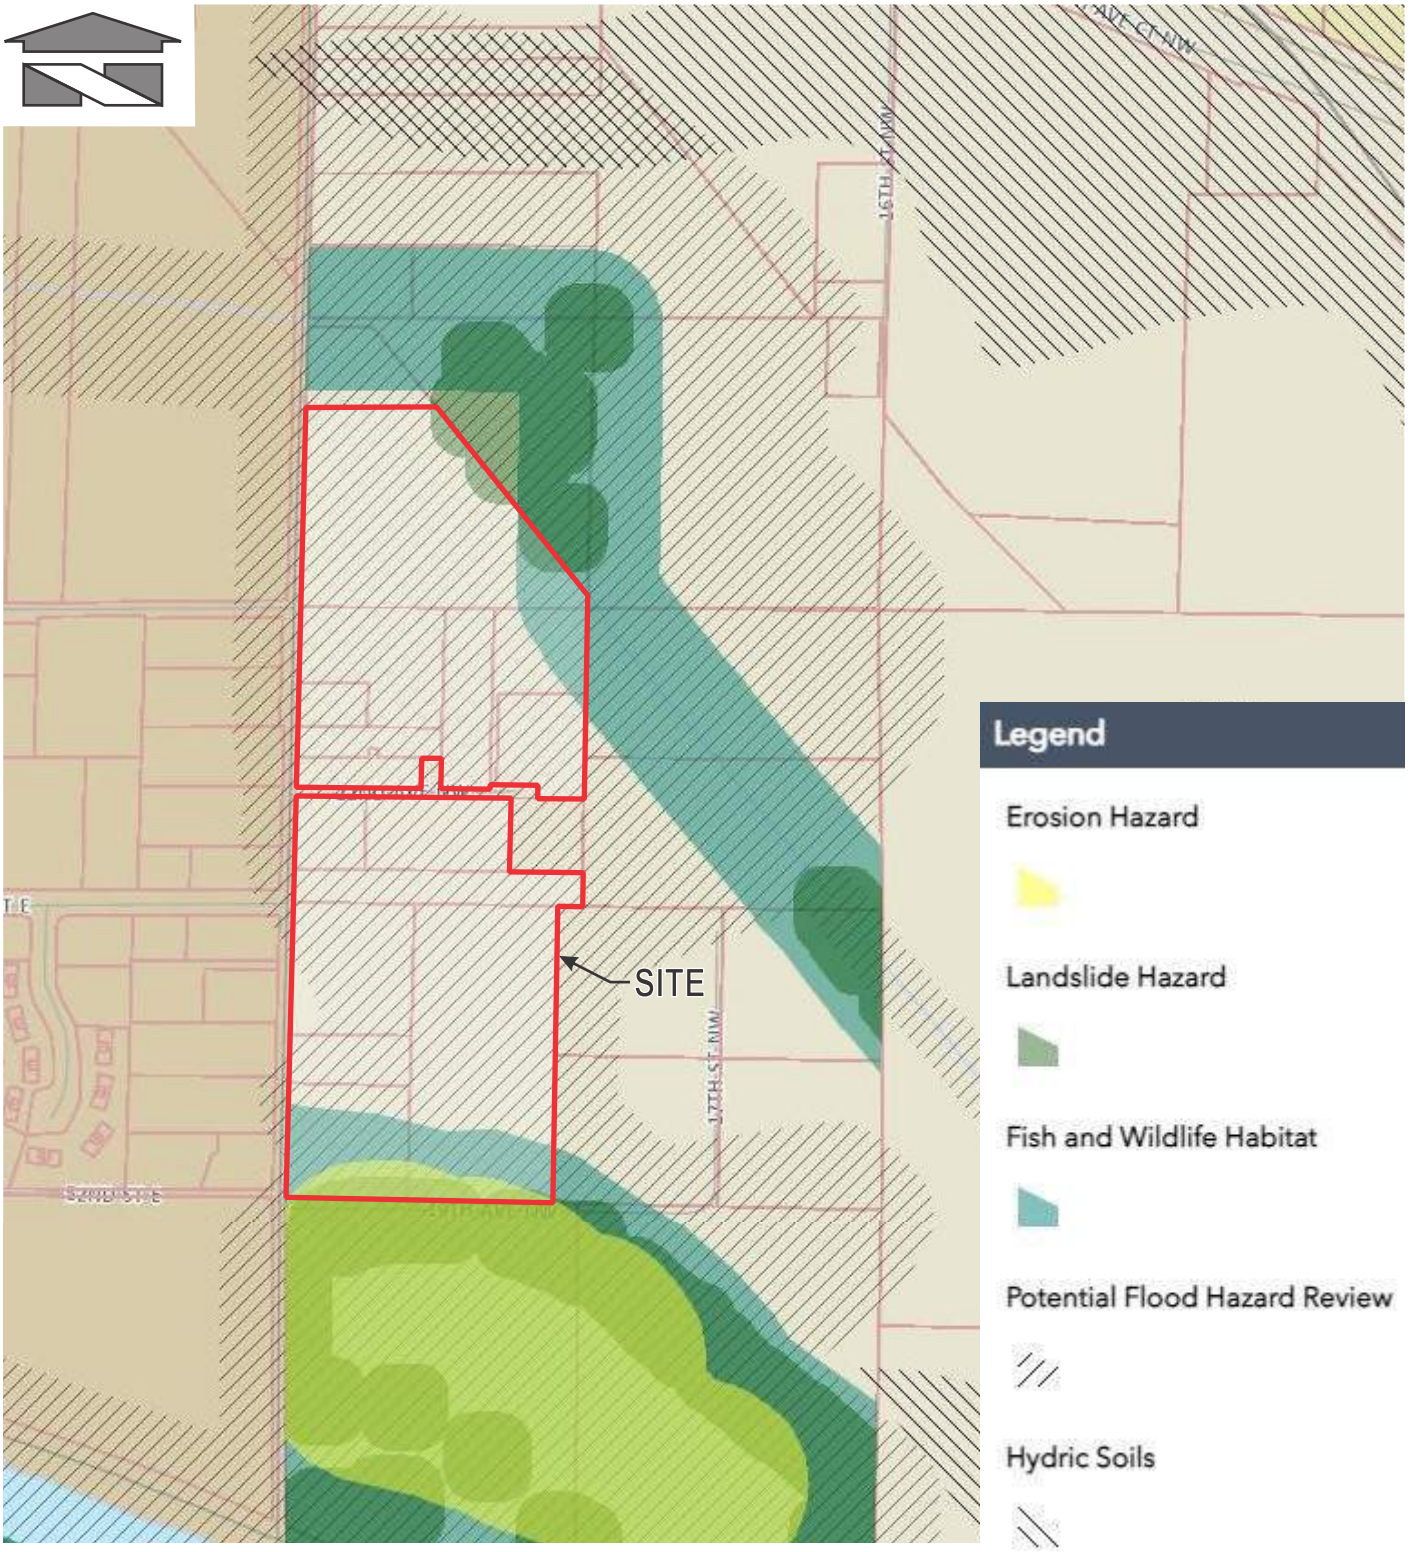

REFERENCE: Pierce County PublicGIS

Scale:
Horizontal: **N.T.S.** Vertical: **N/A**

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

For:
Freeman Road Logistics
Fife, Washington

Title:
SENSITIVE AREAS MAP

Job Number
21585

DATE: 09/01/22

P:\21000s\21585\exhibit\graphics\21585 sens.cdr

Tab 3.0

3.0 EXISTING CONDITIONS SUMMARY

3.0 EXISTING CONDITIONS SUMMARY


Under existing conditions, the project site consists of farmland and scattered single-family houses. The Geotechnical report (included as a separate document in this submittal) and Soil Survey Map indicates that the site is mainly comprised of Alluvium. Further discussion of the soils can be found in the soils report prepared for this project. A soils map has also been provided. The site has very little slope and poorly defined drainage. A 12” culvert at the northwest site corner appears to be the primary outlet point for the majority of site runoff. There are no water features onsite. Vegetation is predominantly pasture in the north, prior crop use in the south, plus a few scattered trees and lawn adjacent the single-family homes. A small (±1,200 sf) wetland is located onsite in the northeast. Offsite wetlands are located offsite to the east and south. Refer to the Critical Areas Report prepared for the project for more information, included in Section 6.0 of this report. The existing frontage roads are small two-lane roads with minimal shoulders and no storm conveyance.

EXISTING CONDITIONS MAP

EXISTING CONDITIONS
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 25' 50' 100'
SCALE: 1"=50'

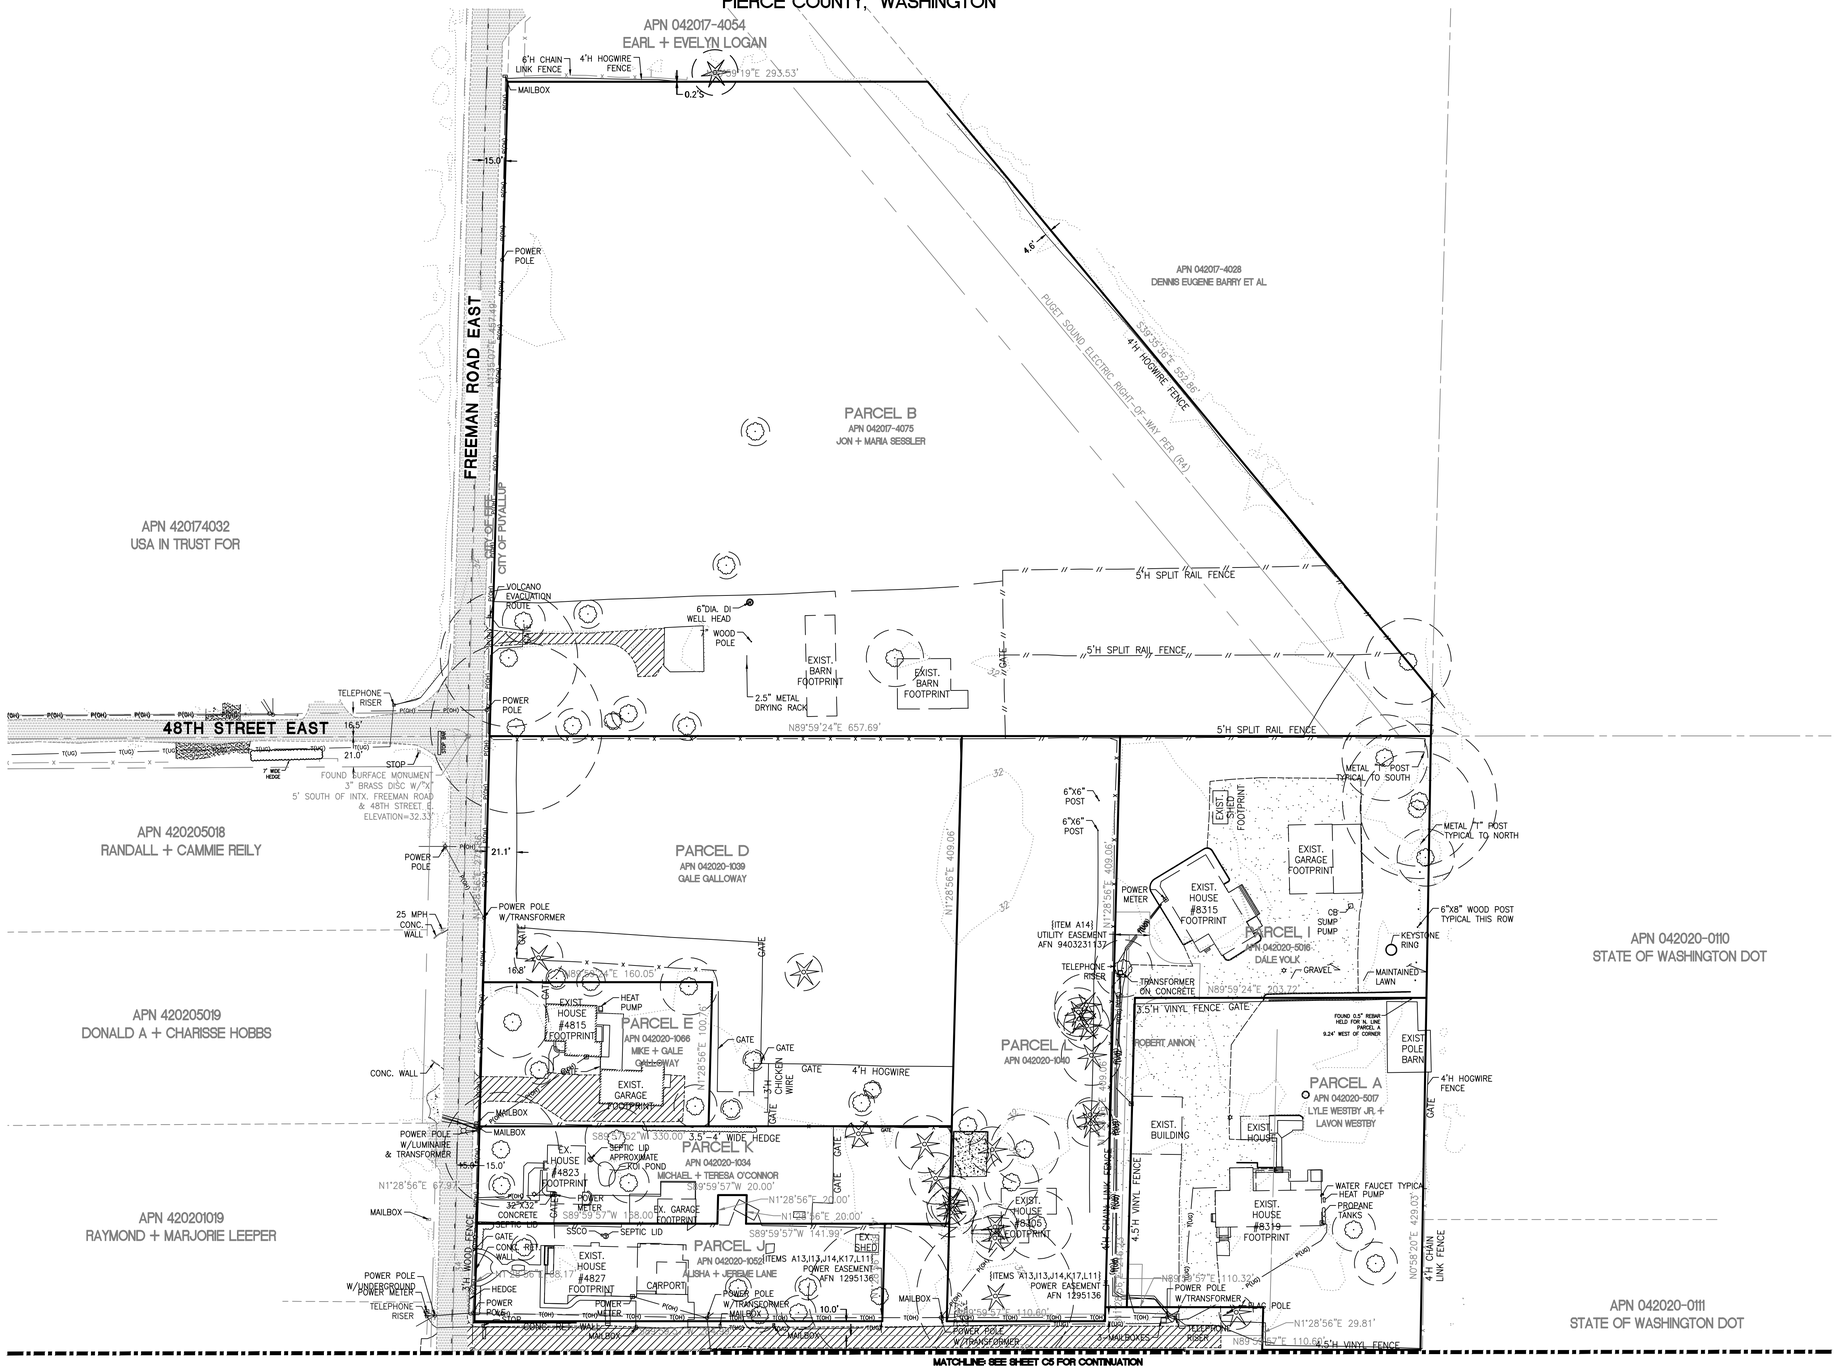

LEGEND

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- SURVEY MONUMENT (AS NOTED)
- SECTION CORNER (AS NOTED)
- SET REBAR/CAP (LS#45789 OR #41282)
- FOUND REBAR/CAP (AS NOTED)
- SET 2"X2" HUB/TACK LINE STAKE
- MAG/WASHER OR LEAD/TACK (AS NOTED)
- LUMINAIRE (LUM.)
- YARD LIGHT
- ORNAMENTAL LIGHT
- POWER METER (PM)
- POWER POLE (PP)
- JUNCTION BOX (AS NOTED)
- TELEPHONE MANHOLE (TM)
- TELEPHONE RISER (TR)
- CATCH BASIN (CB)
- STORM MANHOLE (SDMH)
- SANITARY SEWER MANHOLE (SSMH)
- GAS METER (GM)
- GAS VALVE (GV)
- WATER VALVE (WV)
- FAUCET
- FIRE HYDRANT(FH)
- WATER MANHOLE
- WATER METER (WM)
- WELL
- SIGN
- IRRIGATION VALVE (IV)
- DIRECTIONAL ARROW
- MAILBOX (MB)
- CHAIN LINK FENCE
- WOOD FENCE
- HOGWIRE FENCE
- VINYL FENCE
- WATER LINE
- GAS LINE
- T(XX) TELEPHONE LINE (OH) OR (UG)
- P(XX) POWER LINE (OH) OR (UG)
- SD STORM LINE
- SS SEWER LINE
- ROCKERY
- KEYSTONE WALL
- DECIDUOUS TREE
- CONIFEROUS TREE
- TREE DRIPLINE
- CONCRETE
- GRAVEL/SAND (AS NOTED)
- ASPHALT
- BUILDING LINE
- ROCK
- MATCH LINE

ABBREVIATIONS

(R#)	REFERENCE SURVEYS
(OH)	OVERHEAD
(UG)	UNDERGROUND
(TYP)	TYPICAL
(C)	CALCULATED
(M)	MEASURED
(GIS)	GEOGRAPHICAL INFORMATION SYSTEMS
(REF)	PER REFERENCE INFORMATION
(H)	HIGH
(IV)	IRRIGATION VALVE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
5	12/02/24	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **EXISTING CONDITIONS**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

Scale: Horizontal 1"=50' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 12/5/24


Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C4 of 44

P:\21000s\21585\engineering\SEPA SET\21585-EX.dwg 12/5/2024 9:41 AM DCASEY

EXISTING CONDITIONS
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

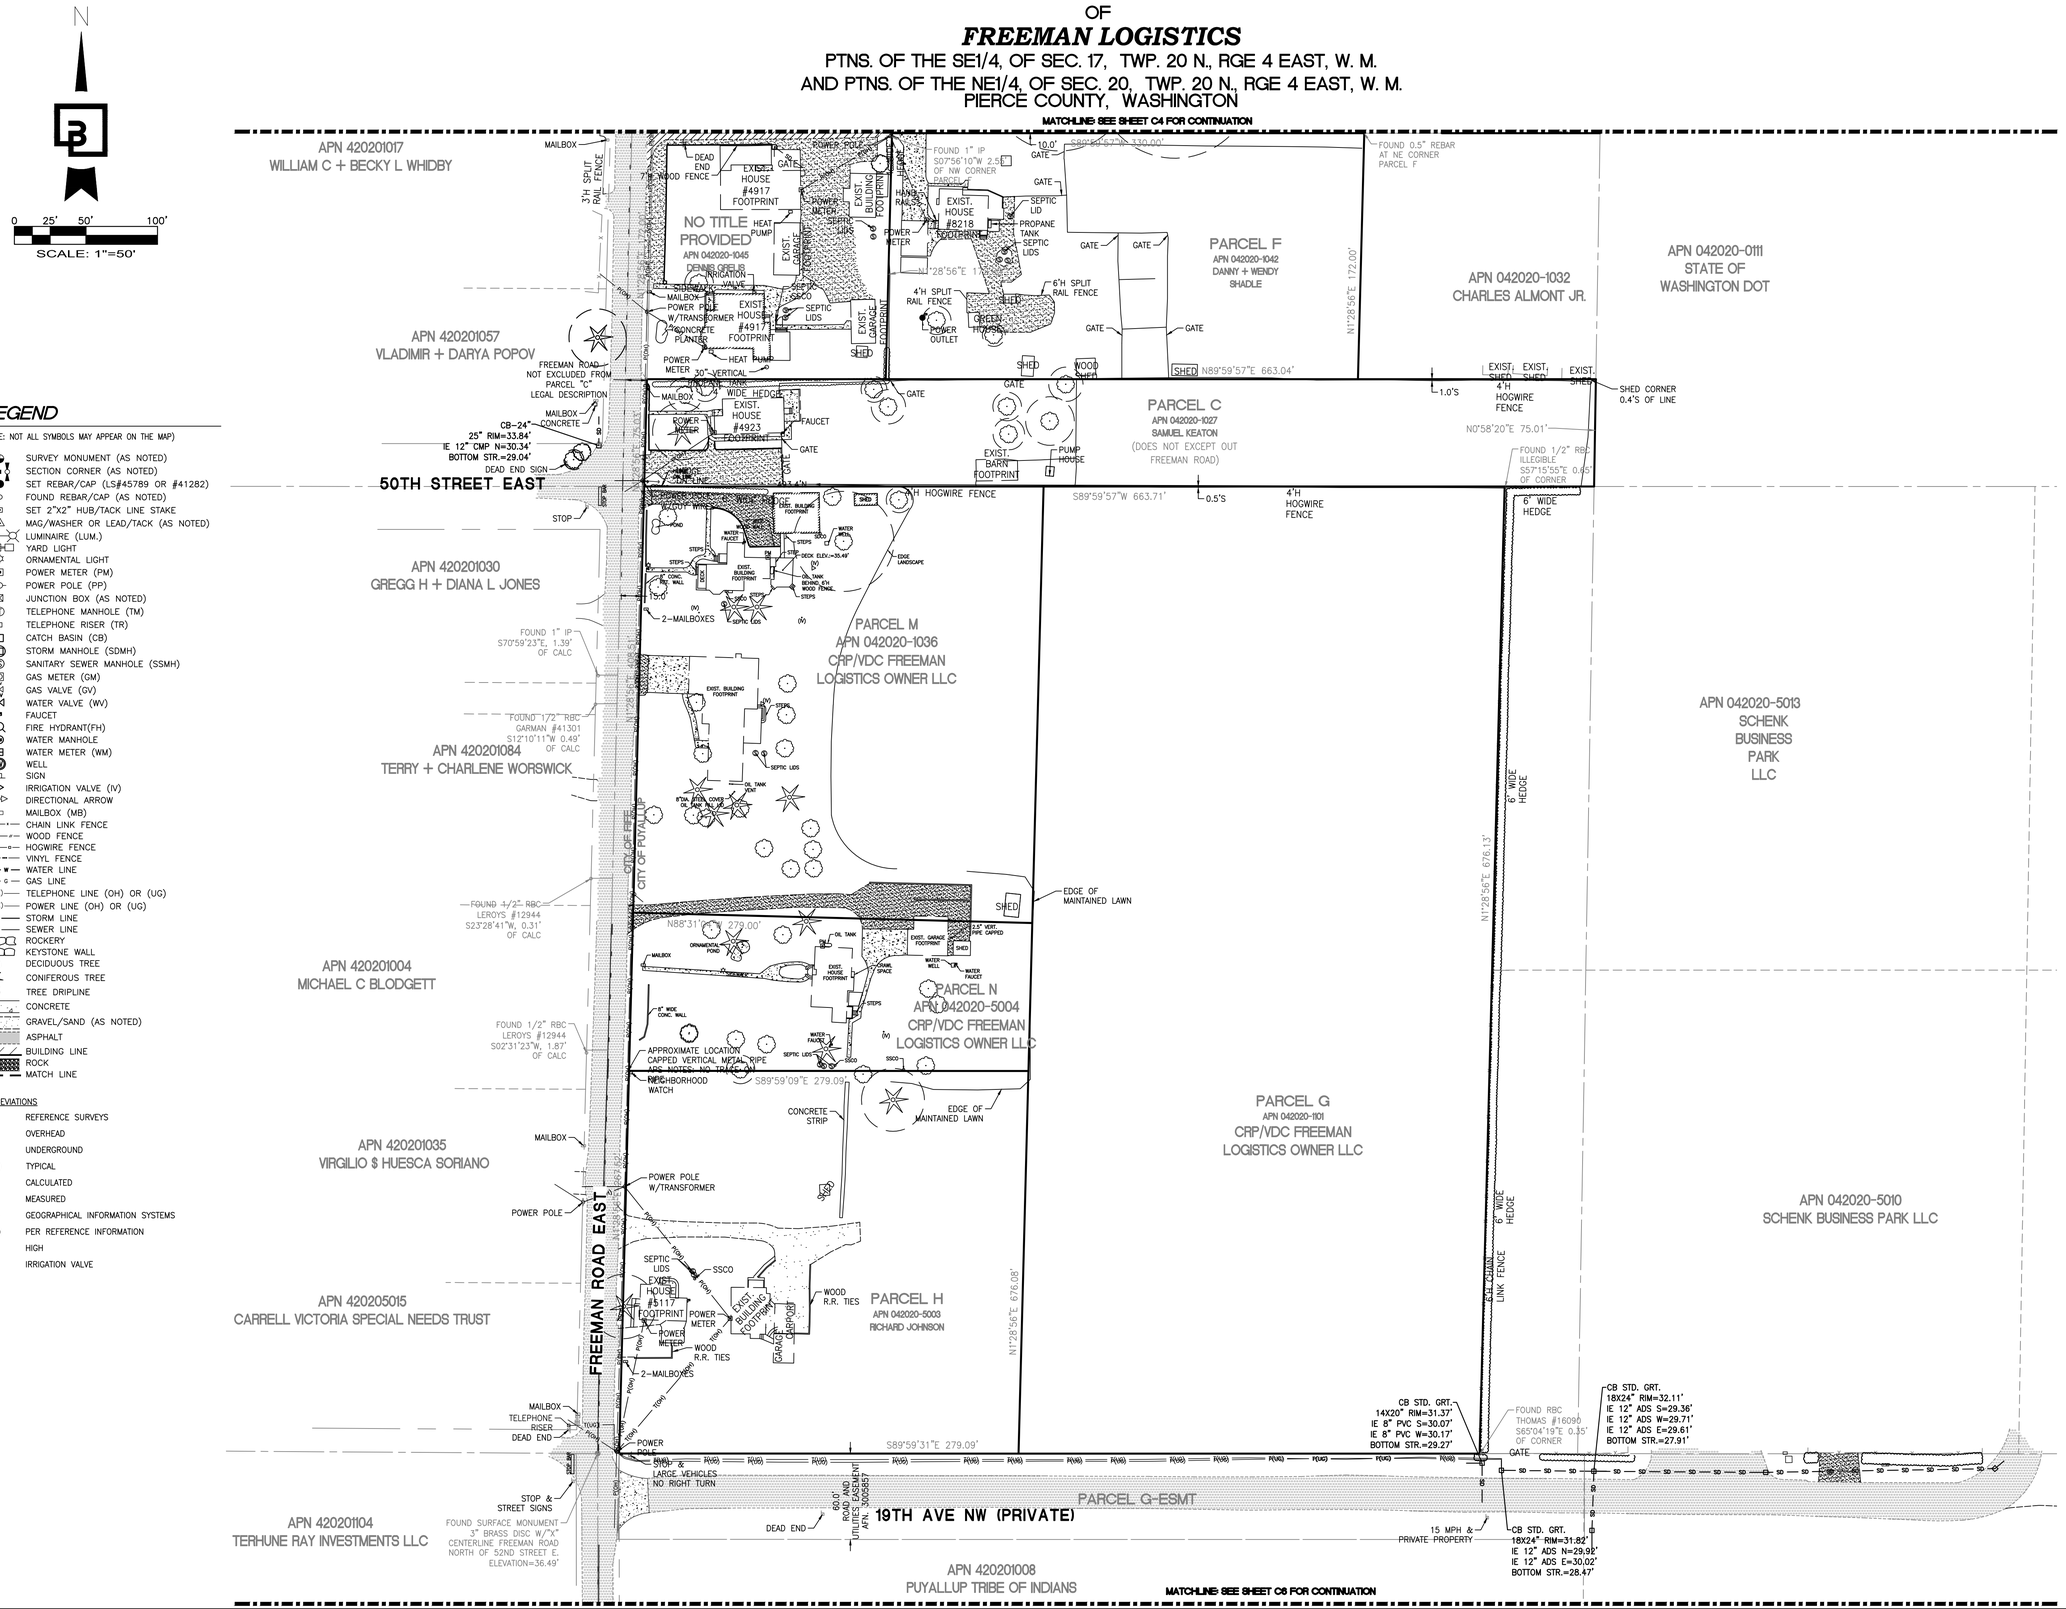
MATCHLINE SEE SHEET C4 FOR CONTINUATION
APN 420201017
WILLIAM C + BECKY L WHIDBY
APN 420201057
VLADIMIR + DARYA POPOV
APN 420201030
GREGG H + DIANA L JONES
APN 420201084
TERRY + CHARLENE WORSWICK
APN 420201004
MICHAEL C BLODGETT
APN 420201035
VIRGILIO $ HUESCA SORIANO
APN 420205015
CARRELL VICTORIA SPECIAL NEEDS TRUST
APN 420201104
TERHUNE RAY INVESTMENTS LLC
APN 420201008
PUYALLUP TRIBE OF INDIANS
APN 042020-1032
CHARLES ALMONT JR.
APN 042020-0111
STATE OF
WASHINGTON DOT
APN 042020-5013
SCHENK
BUSINESS
PARK
LLC
APN 042020-5010
SCHENK BUSINESS PARK LLC
NO TITLE PROVIDED
APN 042020-1045
DENNIS OFFLER
PARCEL F
APN 042020-1042
DANNY + WENDY
SHADLE
PARCEL C
APN 042020-1027
SAMUEL KEATON
(DOES NOT EXCEPT OUT
FREEMAN ROAD)
PARCEL M
APN 042020-1036
CRP/VDC FREEMAN
LOGISTICS OWNER LLC
PARCEL N
APN 042020-5004
CRP/VDC FREEMAN
LOGISTICS OWNER LLC
PARCEL G
APN 042020-1101
CRP/VDC FREEMAN
LOGISTICS OWNER LLC
PARCEL H
APN 042020-5003
RICHARD JOHNSON
PARCEL G-ESMT
50TH STREET EAST
FREEMAN ROAD EAST
19TH AVE NW (PRIVATE)
FREEMAN ROAD
NOT EXCLUDED FROM
PARCEL "C"
LEGAL DESCRIPTION
EXIST. HOUSE #4917 FOOTPRINT
EXIST. HOUSE #4923 FOOTPRINT
EXIST. HOUSE #5117 FOOTPRINT
EXIST. HOUSE #8218 FOOTPRINT
EXIST. BUILDING FOOTPRINT
EXIST. GARAGE FOOTPRINT
EXIST. BARN FOOTPRINT
SHED
GREEN HOUSE
PUMP HOUSE
OIL TANK
WATER WELL
SEPTIC LIDS
POWER METER
POWER POLE
POWER POLE W/TRANSFORMER
MAILBOX
2-MAILBOXES
HEAT PUMP
IRRIGATION VALVE
PROPANE TANK
CONCRETE PLANTER
DEAD END FENCE
3'H SPLIT RAIL FENCE
4'H SPLIT RAIL FENCE
6'H SPLIT RAIL FENCE
4'H HOGWIRE FENCE
6' WIDE HEDGE
CHAIN LINK FENCE
WOOD FENCE
CONCRETE STRIP
EDGE OF MAINTAINED LAWN
EDGE LANDSCAPE
STOP
STOP & STREET SIGNS
STOP & LARGE VEHICLES NO RIGHT TURN
15 MPH & PRIVATE PROPERTY
DEAD END
CB-24" 25" RIM=33.84' IE 12" CMP N=30.34' BOTTOM STR.=29.04'
CB STD. GRT. 14X20" RIM=31.37' IE 8" PVC S=30.07' IE 8" PVC W=30.17' BOTTOM STR.=29.27'
CB STD. GRT. 18X24" RIM=32.11' IE 12" ADS S=29.36' IE 12" ADS W=29.71' IE 12" ADS E=29.61' BOTTOM STR.=27.91'
CB STD. GRT. 18X24" RIM=31.82' IE 12" ADS N=29.92' IE 12" ADS E=30.02' BOTTOM STR.=28.47'
FOUND 1" IP S07°56'10"W 2.5' OF NW CORNER PARCEL F
FOUND 0.5" REBAR AT NE CORNER PARCEL F
FOUND 1" IP S70°59'23"E, 1.39' OF CALC
FOUND 1/2" RBC GARMAN #41301 S12°10'11"W 0.49' OF CALC
FOUND 1/2" RBC LEROYS #12944 S23°28'41"W, 0.31' OF CALC
FOUND 1/2" RBC LEROYS #12944 S02°31'23"W, 1.87' OF CALC
FOUND 1/2" RBC THOMAS #16090 S65°04'19"E 0.35' OF CORNER
FOUND 1/2" RBC ILLEGIBLE S57°15'55"E 0.65' OF CORNER
APPROXIMATE LOCATION CAPPED VERTICAL METAL RIPE ADS NOTES: NO TRACE OF NEIGHBORHOOD WATCH
FOUND SURFACE MONUMENT 3" BRASS DISC W/"X" CENTERLINE FREEMAN ROAD NORTH OF 52ND STREET E. ELEVATION=36.49'
60.0' ROAD AND UTILITIES EASEMENT AFN. 3000857
N88°31'00"E 279.00'
S89°59'09"E 279.09'
S89°59'31"E 279.09'
S89°59'57"W 330.00'
S89°59'57"W 663.04'
S89°59'57"W 663.71'
N1°28'56"E 172.00'
N1°28'56"E 676.08'
N1°28'56"E 676.13'
N0°58'20"E 75.01'
1.0'S
0.5'S
SHED CORNER 0.4'S OF LINE
SSCO
EXIST. GARAGE FOOTPRINT
EXIST. BUILDING FOOTPRINT
OIL TANK
ORNAMENTAL POND
WATER FAUCET
WATER METER
STEPS
8" WIDE CONC. WALL
CONCRETE PLANTER
OIL TANK FILL
OIL TANK VENT
8'DIA. MTOR. COVER OIL TANK INSP. PORT
2.5" VENT PIPE CAPPED
SEPTIC LIDS
EXIST. CRAWL SPACE
EXIST. GARAGE FOOTPRINT
WOOD R.R. TIES
GARAGE DEPOSIT
EXIST. BUILDING FOOTPRINT
EXIST. BARN FOOTPRINT
EXIST. SHED
EXIST. SHED
EXIST. SHED
EXIST. SHED
WOOD SHED
SHED
GATE
GATE
GATE

EXISTING CONDITIONS

OF


FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 25' 50' 100'

SCALE: 1"=50'

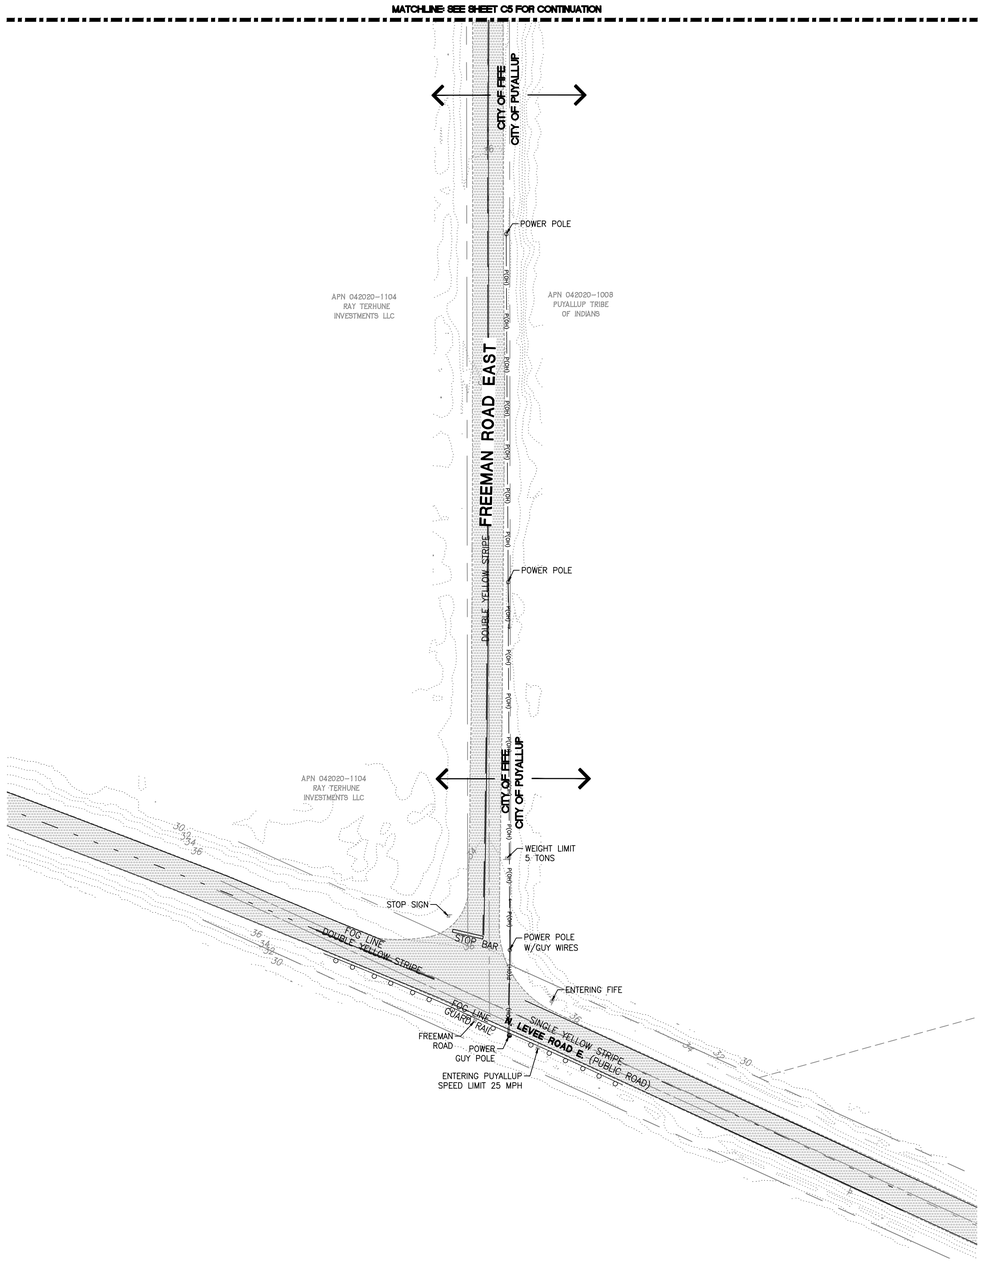

LEGEND

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- SURVEY MONUMENT (AS NOTED)
- SECTION CORNER (AS NOTED)
- SET REBAR/CAP (LS#45789 OR #41282)
- FOUND REBAR/CAP (AS NOTED)
- SET 2"X2" HUB/TACK LINE STAKE
- MAG/WASHER OR LEAD/TACK (AS NOTED)
- LUMINAIRE (LUM.)
- YARD LIGHT
- ORNAMENTAL LIGHT
- POWER METER (PM)
- POWER POLE (PP)
- JUNCTION BOX (AS NOTED)
- TELEPHONE MANHOLE (TM)
- TELEPHONE RISER (TR)
- CATCH BASIN (CB)
- STORM MANHOLE (SDMH)
- SANITARY SEWER MANHOLE (SSMH)
- GAS METER (GM)
- GAS VALVE (GV)
- WATER VALVE (WV)
- FAUCET
- FIRE HYDRANT(FH)
- WATER MANHOLE
- WATER METER (WM)
- WELL
- SIGN
- IRRIGATION VALVE (IV)
- DIRECTIONAL ARROW
- MAILBOX (MB)
- CHAIN LINK FENCE
- WOOD FENCE
- HOGWIRE FENCE
- VINYL FENCE
- WATER LINE
- GAS LINE
- T(XX) TELEPHONE LINE (OH) OR (UG)
- P(XX) POWER LINE (OH) OR (UG)
- SD STORM LINE
- SS SEWER LINE
- ROCKERY
- KEYSTONE WALL
- DECIDUOUS TREE
- CONIFEROUS TREE
- TREE DRIPLINE
- CONCRETE
- GRAVEL/SAND (AS NOTED)
- ASPHALT
- BUILDING LINE
- ROCK
- MATCH LINE

ABBREVIATIONS

(R#)	REFERENCE SURVEYS
(OH)	OVERHEAD
(UG)	UNDERGROUND
(TYP)	TYPICAL
(C)	CALCULATED
(M)	MEASURED
(GIS)	GEOGRAPHICAL INFORMATION SYSTEMS
(REF)	PER REFERENCE INFORMATION
(H)	HIGH
(IV)	IRRIGATION VALVE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
5	12/02/24	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **EXISTING CONDITIONS**

FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Scale: Horizontal 1"=50' Vertical N/A

Designed JSM. Drawn DTC. Checked JSM. Approved JSM. Date 12/5/24

Job Number 21585

Sheet C6 of 44

P:\21000s\21585\engineering\SEPA SET\21585-EX.dwg 12/5/2024 9:41 AM DCASEY

Tab 4.0

4.0 OFF-SITE ANALYSIS REPORT

4.0 OFF-SITE ANALYSIS REPORT

Onsite Description

The project site lies in a very flat section of the valley which has historically been used mostly for agriculture. The soils are fine grained alluvial deposits. Infiltration potential is minimal per the geotechnical engineering report. High seasonal groundwater and low infiltration rates are the main concerns regarding feasibility of infiltration facilities.

The topography does not have a consistent gradient, with the southern half generally trending to the northeast, while the north of the site generally slopes to the northwest. There are no drainage devices onsite and all drainage consists of sheet flow and shallow concentrated flow. The outlet point for the majority of runoff from the site is a 12" concrete culvert which crosses under Freeman Road at the northwest property corner. Some runoff appears to drain offsite along the east edge of the property into an adjacent agricultural ditch just offsite. This ditch routes flows north and then west and eventually crosses Freeman Road about 200' north of the project site, where the two downstream paths merge.

Upstream Description

There does not appear to be an upstream basin tributary to the site under typical drainage conditions. The Schenk property (Parcels 042020-5010, -5011, -5012, -5013) to the SE of the site has a private drainage system which collects runoff. The undeveloped properties immediately east and northeast of the site drain to the agricultural ditch which routes flow north and then west away from the subject property. Properties to the north are graded away from the site. Freeman road is higher than surrounding grade and prevents runoff from single family properties to the west. The parcel to the south is located at a lower elevation and separated from the site by 19th Ave NW. The site does not typically receive runoff from surrounding properties.

During heavy winter storm events, the site experiences a small amount of overtopping from the adjacent agricultural ditch to the east. Stormwater which overtops the ditch sheet flows northwest across the north site edge and then leaves the site via the main 12" outlet pipe crossing Freeman Road. This condition appears to be infrequent and does not present a significant flooding or erosion hazard to the site.

Natural Downstream Description

Stormwater runoff from the site initially takes one of two paths. The majority of runoff leaves the NW site corner through a shallow 12" concrete culvert and crosses under Freeman Road to the west. From there, runoff travels in a roadside vegetated ditch along the west side of Freeman Road north for approximately 230 feet. The ditch then joins a larger agricultural ditch which flows to the west through private property. The agricultural ditch has approximately 3' depth, 3' bottom width, variable side slopes, and relatively smooth bottom. A second runoff path involves sheet flow leaving the site along the east and then entering the same agricultural ditch at a further point upstream. The ditch then travels north and west around neighboring properties and rejoins the main downstream path at the approximate 1/4-mile point. The site is effectively a single threshold discharge area.

After merging in the agricultural ditch on the west side of Freeman Road, runoff from the site continues to the west across private property for 1/4 mile until approximately 78th Ave East. The observable portion of this ditch appears to have relatively consistent characteristics and no obstructions. From 78th Ave, the downstream path meanders through several developed commercial/industrial properties in a general westward progression through manmade conveyance elements. The size and type of the conveyance elements vary along this stretch. Most of the system is tight-lined (36-inch to 48-inch diameter pipe). The commercial properties west of 78th Ave appear to be equipped with onsite detention systems to mitigate stormwater flow rates. The downstream system eventually crosses under 70th Ave East in a 48-inch pipe and then outlets to the oxbow wetland located between 54th Ave E and 70th Ave E. The oxbow is

approximately 1.25 miles downstream of the project site.

Proposed Downstream Description

Due to difficulties with obtaining rights to discharge stormwater into the natural location, the project is proposing an alternate route. Stormwater detention and treatment systems are proposed onsite. After treatment, flows are conveyed to a central lift station located near the west-central part of the site. Stormwater is then pumped south on Freeman Rd, then east on N Levee Road, connecting to existing Puyallup conveyance infrastructure near the intersection of N Levee Road and Industrial Parkway. The existing stormwater system is made up of conventional gravity pipe and catch basins which flow to the east. The pipes progress from 30-inch to 84-inch diameter at the Puyallup River outlet. The outlet pipe is located approximately 3,400 feet east of the force main connection point at Industrial Parkway. A conveyance analysis of the existing gravity network is provided below. The proposed stormwater outlet is to the same ultimate receiving water (Puyallup River) as the natural discharge.

Downstream Conveyance Analysis

See the preliminary conveyance calculations at the end of this section using Autodesk Storm and Sanitary Analysis 2024 (SSA). The analysis includes the proposed parcels and frontage streets of Freeman Logistics (±1.1M square feet), plus all known existing tributaries to the public storm system in Levee Road. The force main from Freeman Logistics is designed to outlet at an existing storm structure at the northeast corner of N. Levee Road and Industrial Parkway, labeled as “Ex. SDMH #4”. From here, stormwater is conveyed by gravity to the east for approximately 3/4 of a mile until ultimately discharging into the Puyallup River through an 84-inch culvert. All the storm elements in the gravity system are existing, city-owned pipes and structures. Pipe and structure elevations were determined by record drawings and publicly available data. Tributary areas (catchments) to each storm junction were derived from Puyallup GIS mapping. Land use coefficients were chosen for conservatism, with existing site coverage modeled as-is in most instances for the commercial properties along Levee Road. Flows from Freeman Logistics were taken from the WWHM due to higher accuracy versus the single event method used in SSA. Flows for the existing Riverfront Industrial Park on Industrial Pkwy were taken from the drainage report prepared for that property (SBUH method, detained flows). N Levee Road runoff is accounted for using fully impervious land coverage (yellow areas on the *N Levee Rd Conveyance* exhibit).

A large subbasin is tributary to the downstream (east) end of the conveyance network near the 84-inch outlet pipe. This subbasin includes substantial area from properties along Valley Ave E to the north of Levee Road, as well as from the upper reach of Wapato Creek (also noted as “Simons Creek” on some sources) to the east of Meridian Ave, totaling an estimated 400 acres. The land coverage for this subbasin is varied and estimated at 50% impervious coverage. The actual size of this catchment has not been studied in detail and is not fully depicted on the attached exhibits. This catchment is directed into the downstream end of the pipe network and does not appear to be a limiting factor for conveyance capacity.

The SSA model uses the SBUH single event method. The design storm has a 25-year recurrence interval with 3.45-inches rainfall and SCS Type IA 24-hour distribution. For conservatism, the outfall to the Puyallup River is modeled to be partially backwatered. The analysis results show capacity in the Levee Road conveyance system to accommodate the design storm. We do not anticipate the addition of runoff from the subject development to cause flooding of the downstream conveyance system.

Frontage Description and Downstream - Levee Intersection


Frontage improvements are required to the south of the project on Freeman Road between 19th Ave NW and Levee Rd. The improvements include widening the travel lanes and significant changes to the intersection of Freeman and Levee Road. The intersection changes include realignment, adding turn lanes, lighting, channelization, and stormwater infrastructure. Much of the new improvements are within

Pierce County TPN. 0420201104 and require an easement from the property owner.

There is no existing storm infrastructure in place. Runoff goes to the shoulder and is presumed to infiltrate into the native soils. The surrounding parcels are undeveloped and forested. There is no concentrated runoff.

Terra Associates provided seasonal groundwater monitoring and infiltration testing along the west side of Freeman Road adjacent to TPN. 0420201104. The design infiltration rate is 1.5 inches per hour. The seasonal high groundwater elevation is approximately 22 feet (NAVD 88). Refer to letters from Terra Associates under separate cover.

OFFSITE ANALYSIS BASIN MAPS

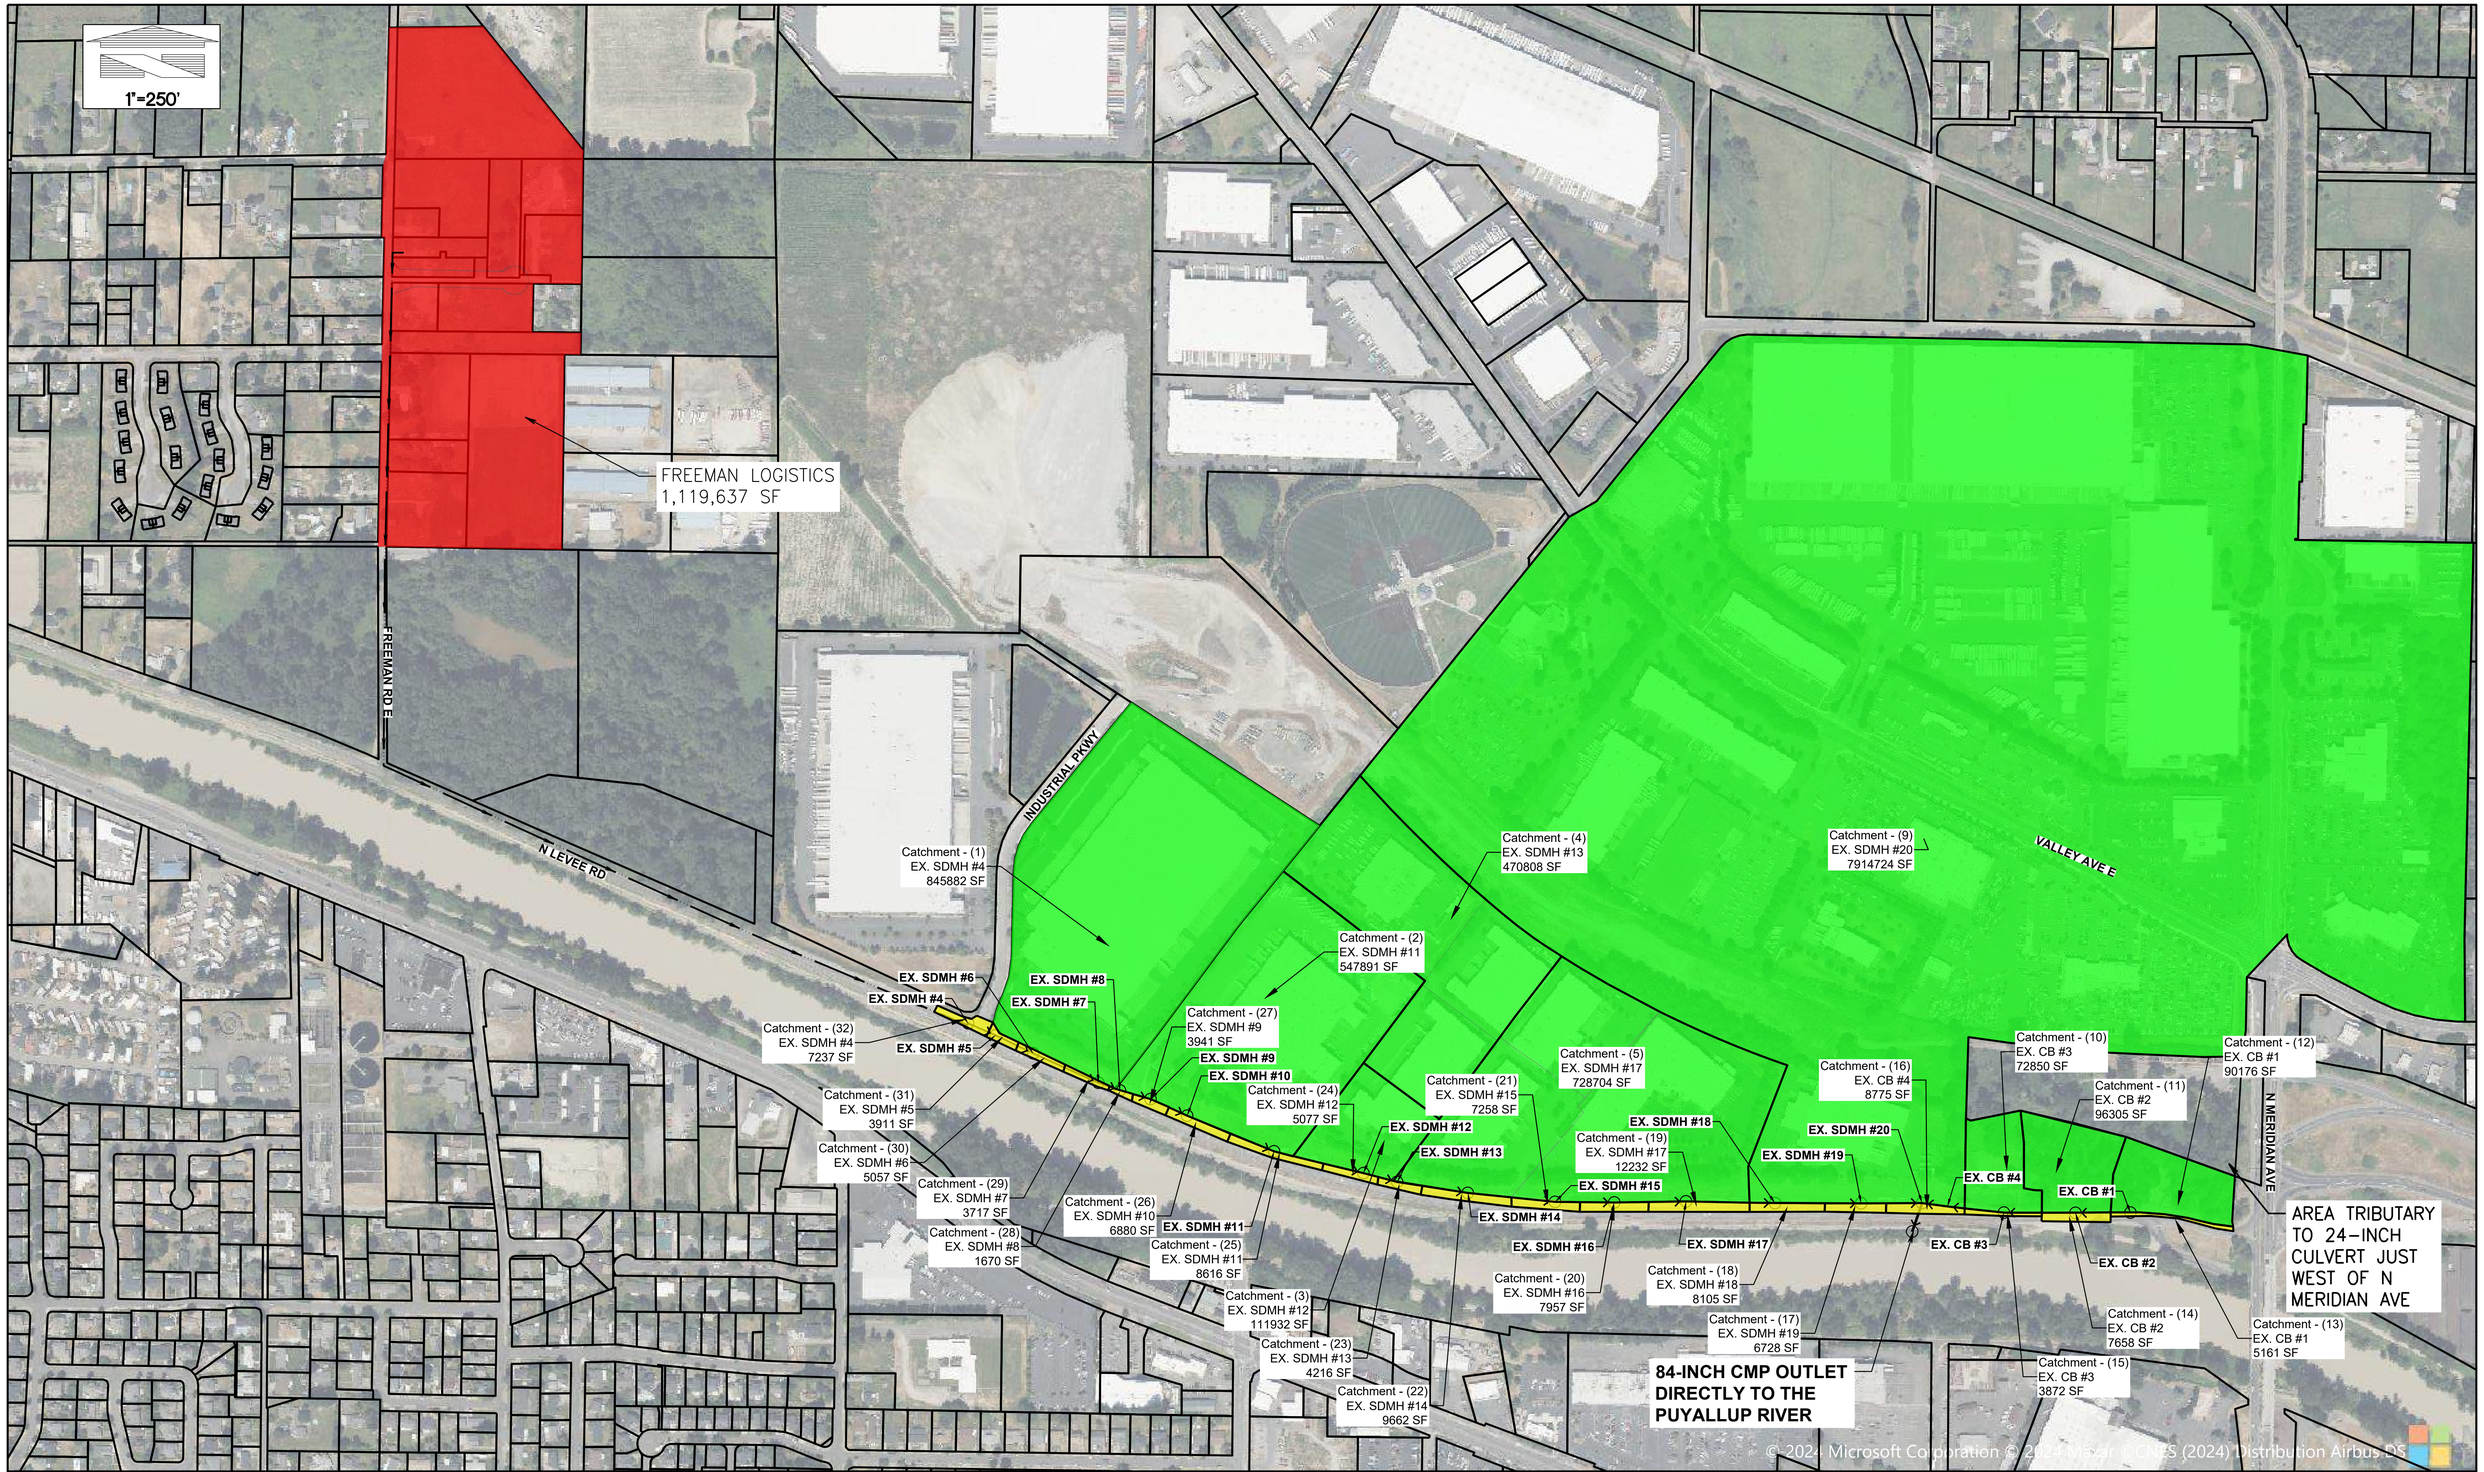

No.	Date	By	Ckd.	Appr.	Revision

Designed JSM
Drawn DTC
Checked JSM
Approved
Date 12/9/24

Scale:
Horizontal
1"=250'
Vertical

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

For:
VECTOR DEVELOPMENT COMPANY

Title:
N LEVEE RD CONVEYANCE

Job Number
21585

Sheet
1 of 1



No.	Date	By	Ckd.	Appr.	Revision

Designed JSM
Drawn DTC
Checked JSM
Approved
Date 12/5/24

Scale:
Horizontal
1"=250'
Vertical

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

For:
VECTOR DEVELOPMENT COMPANY

Title:
DOWNSTREAM EXHIBIT

Job Number
21585

Sheet
1 of 1

OFFSITE CONVEYANCE CALCULATIONS

Autodesk® Storm and Sanitary Analysis 2024 - Version 13.6.323 (Build 0)

****
Project Description
****
File Name 21585-downstream Levee-2025-05-30.SPF

****
Analysis Options
****
Flow Units ..... cfs
Subbasin Hydrograph Method. Santa Barbara UH
Time of Concentration..... SCS TR-55
Link Routing Method ..... Hydrodynamic
Storage Node Exfiltration.. None
Starting Date SEP-13-2024 00:00:00
Ending Date SEP-14-2024 00:00:00
Report Time Step 00:00:10

****
Element Count
****
Number of rain gages 1
Number of subbasins 29
Number of nodes 22
Number of links 21

****
Raingage Summary
****

Gage ID	Data Source	Data Type	Recording Interval min
25-YEAR_PC	TS-01	CUMULATIVE	6.00

****
Subbasin Summary
****

Subbasin ID	Total Area acres	Imperv. Area %	Raingage
LEVEE_CB#1	0.12	100.00	25-YEAR_PC
LEVEE_CB#1_FOREST	2.07	0.00	25-YEAR_PC
LEVEE_CB#2	0.18	100.00	25-YEAR_PC
LEVEE_CB#2_FOREST	2.22	0.00	25-YEAR_PC
LEVEE_CB#3	0.09	100.00	25-YEAR_PC
LEVEE_CB#3_FOREST	1.67	0.00	25-YEAR_PC
LEVEE_CB#4	0.20	100.00	25-YEAR_PC
LEVEE_SDMH#10	0.16	100.00	25-YEAR_PC
LEVEE_SDMH#11	0.20	100.00	25-YEAR_PC
LEVEE_SDMH#12	0.12	100.00	25-YEAR_PC
LEVEE_SDMH#13	0.11	100.00	25-YEAR_PC
LEVEE_SDMH#14	0.23	100.00	25-YEAR_PC
LEVEE_SDMH#15	0.18	100.00	25-YEAR_PC
LEVEE_SDMH#16	0.19	100.00	25-YEAR_PC
LEVEE_SDMH#17	0.28	100.00	25-YEAR_PC
LEVEE_SDMH#18	0.19	100.00	25-YEAR_PC
LEVEE_SDMH#19	0.15	100.00	25-YEAR_PC
LEVEE_SDMH#4	0.17	100.00	25-YEAR_PC

LEVEE_SDMH#5	0.09	100.00	25-YEAR_PC
LEVEE_SDMH#6	0.12	100.00	25-YEAR_PC
LEVEE_SDMH#7	0.09	100.00	25-YEAR_PC
LEVEE_SDMH#8	0.04	100.00	25-YEAR_PC
LEVEE_SDMH#9	0.09	100.00	25-YEAR_PC
Sub-EX. SDMH #11	12.58	90.00	25-YEAR_PC
Sub-EX. SDMH #12	2.57	90.00	25-YEAR_PC
Sub-EX. SDMH #13	10.81	90.00	25-YEAR_PC
Sub-EX. SDMH #17	16.73	90.00	25-YEAR_PC
Sub-EX. SDMH #4	45.12	90.00	25-YEAR_PC
Sub-EX_SDMH#20	400.00	50.00	25-YEAR_PC

Includes Fred Meyer Distribution Center and properties along Valley Ave, plus significant upstream area from Wapato Creek east of Meridian. Subbasin size and impervious coverage estimated.

****
Node Summary
****

Node ID	Element Type	Invert Elevation ft	Maximum Elev. ft	Ponded Area ft²	External Inflow
EX. CB #1	JUNCTION	33.00	34.88	100.00	
EX. CB #2	JUNCTION	32.59	34.48	100.00	
EX. CB #3	JUNCTION	32.07	33.95	100.00	
EX. SDMH #10	JUNCTION	31.70	40.00	100.00	
EX. SDMH #11	JUNCTION	30.97	40.00	100.00	
EX. SDMH #12	JUNCTION	30.74	39.00	100.00	
EX. SDMH #13	JUNCTION	30.27	39.00	100.00	
EX. SDMH #14	JUNCTION	29.42	38.00	100.00	
EX. SDMH #15	JUNCTION	28.81	39.00	100.00	
EX. SDMH #16	JUNCTION	28.39	38.20	100.00	
EX. SDMH #17	JUNCTION	27.89	38.00	100.00	
EX. SDMH #18	JUNCTION	27.27	38.50	100.00	
EX. SDMH #19	JUNCTION	26.67	38.20	100.00	
EX. SDMH #20	JUNCTION	24.09	38.00	100.00	
EX. SDMH #4	JUNCTION	34.27	38.67	100.00	
EX. SDMH #5	JUNCTION	33.73	38.63	100.00	
EX. SDMH #6	JUNCTION	33.37	39.09	100.00	
EX. SDMH #7	JUNCTION	32.74	39.36	100.00	
EX. SDMH #8	JUNCTION	32.54	39.40	100.00	
EX. SDMH #9	JUNCTION	32.24	40.00	100.00	
EX.CB#4	JUNCTION	31.65	33.53	100.00	
Out-1Pipe - (62)	OUTFALL	23.88	30.88	0.00	

Pipe length from Puyallup GIS. Slope from best available as-built info

****
Link Summary
****

Link ID	From Node	To Node	Element Type	Length ft	Slope %	Manning's Roughness
Pipe - (43)	EX. SDMH #4	EX. SDMH #5	CONDUIT	105.2	0.5133	0.0120
Pipe - (44)	EX. SDMH #5	EX. SDMH #6	CONDUIT	144.9	0.2484	0.0120
Pipe - (45)	EX. SDMH #6	EX. SDMH #7	CONDUIT	250.3	0.2517	0.0120
Pipe - (46)	EX. SDMH #7	EX. SDMH #8	CONDUIT	79.5	0.2516	0.0120
Pipe - (47)	EX. SDMH #8	EX. SDMH #9	CONDUIT	111.4	0.2513	0.0120
Pipe - (48)	EX. SDMH #9	EX. SDMH #10	CONDUIT	140.5	0.3843	0.0120
Pipe - (49)	EX. SDMH #10	EX. SDMH #11	CONDUIT	328.4	0.2071	0.0120
Pipe - (50)	EX. SDMH #11	EX. SDMH #12	CONDUIT	321.2	0.2000	0.0120
Pipe - (51)	EX. SDMH #12	EX. SDMH #13	CONDUIT	121.5	0.3868	0.0120
Pipe - (52)	EX. SDMH #13	EX. SDMH #14	CONDUIT	250.0	0.3400	0.0120
Pipe - (53)	EX. SDMH #14	EX. SDMH #15	CONDUIT	306.5	0.2000	0.0120
Pipe - (54)	EX. SDMH #15	EX. SDMH #16	CONDUIT	206.8	0.2031	0.0120
Pipe - (55)	EX. SDMH #16	EX. SDMH #17	CONDUIT	250.4	0.2000	0.0120
Pipe - (56)	EX. SDMH #17	EX. SDMH #18	CONDUIT	311.4	0.2000	0.0120
Pipe - (57)	EX. SDMH #18	EX. SDMH #19	CONDUIT	300.8	0.2000	0.0120
Pipe - (58)	EX. SDMH #19	EX. SDMH #20	CONDUIT	213.0	0.2488	0.0120
Pipe - (59)	EX. CB #1	EX. CB #2	CONDUIT	192.3	0.2110	0.0120

Pipe - (60)	EX. CB #2	EX. CB #3	CONDUIT	249.9	0.2110	0.0120
Pipe - (61)	EX.CB#4	EX. SDMH #20	CONDUIT	89.0	0.2110	0.0120
Pipe - (62)	EX. SDMH #20	Out-1Pipe - (62)	CONDUIT	105.5	0.2000	0.0220
Pipe - (63)	EX. CB #3	EX.CB#4	CONDUIT	198.8	0.2110	0.0120

****
Cross Section Summary
****

Link ID	Shape	Depth/ Diameter ft	Width ft	No. of Barrels	Cross Sectional Area ft²	Full Flow Hydraulic Radius ft	Design Flow Capacity cfs
Pipe - (43)	CIRCULAR	2.50	2.50	1	4.91	0.63	31.84
Pipe - (44)	CIRCULAR	2.50	2.50	1	4.91	0.63	22.15
Pipe - (45)	CIRCULAR	2.50	2.50	1	4.91	0.63	22.29
Pipe - (46)	CIRCULAR	2.50	2.50	1	4.91	0.63	22.29
Pipe - (47)	CIRCULAR	2.50	2.50	1	4.91	0.63	22.28
Pipe - (48)	CIRCULAR	2.25	2.25	1	3.98	0.56	20.80
Pipe - (49)	CIRCULAR	2.25	2.25	1	3.98	0.56	15.27
Pipe - (50)	CIRCULAR	2.50	2.50	1	4.91	0.63	19.87
Pipe - (51)	CIRCULAR	3.00	3.00	1	7.07	0.75	44.94
Pipe - (52)	CIRCULAR	3.00	3.00	1	7.07	0.75	42.13
Pipe - (53)	CIRCULAR	3.00	3.00	1	7.07	0.75	32.31
Pipe - (54)	CIRCULAR	3.00	3.00	1	7.07	0.75	32.56
Pipe - (55)	CIRCULAR	3.00	3.00	1	7.07	0.75	32.31
Pipe - (56)	CIRCULAR	3.00	3.00	1	7.07	0.75	32.31
Pipe - (57)	CIRCULAR	3.50	3.50	1	9.62	0.88	48.74
Pipe - (58)	CIRCULAR	3.50	3.50	1	9.62	0.88	54.37
Pipe - (59)	CIRCULAR	1.00	1.00	1	0.79	0.25	1.77
Pipe - (60)	CIRCULAR	1.00	1.00	1	0.79	0.25	1.77
Pipe - (61)	CIRCULAR	1.00	1.00	1	0.79	0.25	1.77
Pipe - (62)	CIRCULAR	7.00	7.00	1	38.48	1.75	168.82
Pipe - (63)	CIRCULAR	1.00	1.00	1	0.79	0.25	1.77

********** Runoff Quantity Continuity **********	Volume acre-ft	Depth inches

Total Precipitation	142.560	3.444
Surface Runoff	90.725	2.192
Continuity Error (%)	-0.000	

Flow Routing Continuity	Volume acre-ft	Volume Mgallons
External Inflow	0.000	0.000
External Outflow	90.660	29.543
Initial Stored Volume	0.045	0.015
Final Stored Volume	0.143	0.047
Continuity Error (%)	0.000	

Composite Curve Number Computations Report

Subbasin LEVEE_CB#1

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.12		98.00

Subbasin LEVEE_CB#1_FOREST

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	2.07		76.00

Subbasin LEVEE_CB#2

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.18		98.00

Subbasin LEVEE_CB#2_FOREST

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	2.22		76.00

Subbasin LEVEE_CB#3

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.09		98.00

Subbasin LEVEE_CB#3_FOREST

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	1.67		76.00

Subbasin LEVEE_CB#4

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.20		98.00

Subbasin LEVEE_SDMH#10

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.16		98.00

Subbasin LEVEE_SDMH#11

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.20		98.00

Subbasin LEVEE_SDMH#12

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.12		98.00

Subbasin LEVEE_SDMH#13

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.11		98.00

Subbasin LEVEE_SDMH#14

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.23		98.00

Subbasin LEVEE_SDMH#15

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.18		98.00

Subbasin LEVEE_SDMH#16

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.19		98.00

Subbasin LEVEE_SDMH#17

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.28		98.00

Subbasin LEVEE_SDMH#18

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.19		98.00

Subbasin LEVEE_SDMH#19

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.15		98.00

Subbasin LEVEE_SDMH#4

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.17		98.00

Subbasin LEVEE_SDMH#5

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.09		98.00

Subbasin LEVEE_SDMH#6

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.12		98.00

Subbasin LEVEE_SDMH#7

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.09		98.00

Subbasin LEVEE_SDMH#8

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	0.04		98.00

Subbasin LEVEE_SDMH#9

Soil/Surface Description	Area (acres)	Soil Group	CN

Composite Area & Weighted CN	0.09		98.00

Subbasin Sub-EX. SDMH #11

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	12.58		95.80

Subbasin Sub-EX. SDMH #12

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	2.57		95.80

Subbasin Sub-EX. SDMH #13

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	10.81		95.80

Subbasin Sub-EX. SDMH #17

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	16.73		95.80

Subbasin Sub-EX. SDMH #4

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	45.12		76.00

Subbasin Sub-EX_SDMH#20

Soil/Surface Description	Area (acres)	Soil Group	CN
Composite Area & Weighted CN	400.00		87.00

****
Runoff Coefficient Computations Report
****

Subbasin LEVEE_CB#1

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	5.00	-	0.72
Composite Area & Weighted Runoff Coeff.	5.00		0.72

Subbasin LEVEE_CB#1_FOREST

	Area	Soil	Runoff

Soil/Surface Description	(acres)	Group	Coeff.
-	2.07	-	0.72
Composite Area & Weighted Runoff Coeff.	2.07		0.72

Subbasin LEVEE_CB#2

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.18	-	0.72
Composite Area & Weighted Runoff Coeff.	0.18		0.72

Subbasin LEVEE_CB#2_FOREST

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	2.22	-	0.72
Composite Area & Weighted Runoff Coeff.	2.22		0.72

Subbasin LEVEE_CB#3

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.09	-	0.72
Composite Area & Weighted Runoff Coeff.	0.09		0.72

Subbasin LEVEE_CB#3_FOREST

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	1.67	-	0.72
Composite Area & Weighted Runoff Coeff.	1.67		0.72

Subbasin LEVEE_CB#4

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.20	-	0.72
Composite Area & Weighted Runoff Coeff.	0.20		0.72

Subbasin LEVEE_SDMH#10

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.16	-	0.72
Composite Area & Weighted Runoff Coeff.	0.16		0.72

Subbasin LEVEE_SDMH#11

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.20	-	0.72
Composite Area & Weighted Runoff Coeff.	0.20		0.72

Subbasin LEVEE_SDMH#12

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.12	-	0.72
Composite Area & Weighted Runoff Coeff.	0.12		0.72

Subbasin LEVEE_SDMH#13

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.11	-	0.72
Composite Area & Weighted Runoff Coeff.	0.11		0.72

Subbasin LEVEE_SDMH#14

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.23	-	0.72
Composite Area & Weighted Runoff Coeff.	0.23		0.72

Subbasin LEVEE_SDMH#15

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.18	-	0.72
Composite Area & Weighted Runoff Coeff.	0.18		0.72

Subbasin LEVEE_SDMH#16

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.19	-	0.72
Composite Area & Weighted Runoff Coeff.	0.19		0.72

Subbasin LEVEE_SDMH#17

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.28	-	0.72
Composite Area & Weighted Runoff Coeff.	0.28		0.72

Subbasin LEVEE_SDMH#18

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.19	-	0.72
Composite Area & Weighted Runoff Coeff.	0.19		0.72

Subbasin LEVEE_SDMH#19

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.15	-	0.72
Composite Area & Weighted Runoff Coeff.	0.15		0.72

Subbasin LEVEE_SDMH#4

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.17	-	0.72
Composite Area & Weighted Runoff Coeff.	0.17		0.72

Subbasin LEVEE_SDMH#5

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.09	-	0.72
Composite Area & Weighted Runoff Coeff.	0.09		0.72

Subbasin LEVEE_SDMH#6

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.12	-	0.72
Composite Area & Weighted Runoff Coeff.	0.12		0.72

Subbasin LEVEE_SDMH#7

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.09	-	0.72
Composite Area & Weighted Runoff Coeff.	0.09		0.72

Subbasin LEVEE_SDMH#8

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.04	-	0.72
Composite Area & Weighted Runoff Coeff.	0.04		0.72

Subbasin LEVEE_SDMH#9

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	0.09	-	0.72
Composite Area & Weighted Runoff Coeff.	0.09		0.72

Subbasin Sub-EX. SDMH #11

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	13.01	-	0.50

Composite Area & Weighted Runoff Coeff.	13.01		0.50

Subbasin Sub-EX. SDMH #12

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	2.57	-	0.50
Composite Area & Weighted Runoff Coeff.	2.57		0.50

Subbasin Sub-EX. SDMH #13

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	10.81	-	0.50
Composite Area & Weighted Runoff Coeff.	10.81		0.50

Subbasin Sub-EX. SDMH #17

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	16.73	-	0.50
Composite Area & Weighted Runoff Coeff.	16.73		0.50

Subbasin Sub-EX. SDMH #4

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	19.19	-	0.50
Composite Area & Weighted Runoff Coeff.	19.19		0.50

Subbasin Sub-EX_SDMH#20

Soil/Surface Description	Area (acres)	Soil Group	Runoff Coeff.
-	182.00	-	0.72
Composite Area & Weighted Runoff Coeff.	182.00		0.72

****
SCS TR-55 Time of Concentration Computations Report
****

Sheet Flow Equation

Tc = (0.007 * ((n * Lf)^0.8)) / ((P^0.5) * (Sf^0.4))

Where:

Tc = Time of Concentration (hrs)
n = Manning's Roughness
Lf = Flow Length (ft)
P = 2 yr, 24 hr Rainfall (inches)
Sf = Slope (ft/ft)

Shallow Concentrated Flow Equation

```
        V  = 16.1345 * (Sf^0.5) (unpaved surface)
        V  = 20.3282 * (Sf^0.5) (paved surface)
        V  = 15.0 * (Sf^0.5) (grassed waterway surface)
        V  = 10.0 * (Sf^0.5) (nearly bare & untilled surface)
        V  = 9.0 * (Sf^0.5) (cultivated straight rows surface)
        V  = 7.0 * (Sf^0.5) (short grass pasture surface)
        V  = 5.0 * (Sf^0.5) (woodland surface)
        V  = 2.5 * (Sf^0.5) (forest w/heavy litter surface)
        Tc = (Lf / V) / (3600 sec/hr)

        Where:

        Tc = Time of Concentration (hrs)
        Lf = Flow Length (ft)
        V  = Velocity (ft/sec)
        Sf = Slope (ft/ft)

Channel Flow Equation
---------------------

        V  = (1.49 * (R^(2/3)) * (Sf^0.5)) / n
        R  = Aq / Wp
        Tc = (Lf / V) / (3600 sec/hr)

        Where:

        Tc = Time of Concentration (hrs)
        Lf = Flow Length (ft)
        R  = Hydraulic Radius (ft)
        Aq = Flow Area (ft²)
        Wp = Wetted Perimeter (ft)
        V  = Velocity (ft/sec)
        Sf = Slope (ft/ft)
        n  = Manning's Roughness

----------------------
Subbasin LEVEE_CB#1
----------------------

        User-Defined TOC override (minutes):      5.00

-----------------------------
Subbasin LEVEE_CB#1_FOREST
-----------------------------

        User-Defined TOC override (minutes):     15.00

----------------------
Subbasin LEVEE_CB#2
----------------------

        User-Defined TOC override (minutes):      5.00

-----------------------------
Subbasin LEVEE_CB#2_FOREST
-----------------------------

        User-Defined TOC override (minutes):     15.00

----------------------
Subbasin LEVEE_CB#3
----------------------

        User-Defined TOC override (minutes):      5.00

-----------------------------
```

```
Subbasin LEVEE_CB#3_FOREST
---------------------------

        User-Defined TOC override (minutes):     15.00

----------------------
Subbasin LEVEE_CB#4
----------------------

        User-Defined TOC override (minutes):      5.00

-------------------------
Subbasin LEVEE_SDMH#10
-------------------------

        User-Defined TOC override (minutes):      5.00

-------------------------
Subbasin LEVEE_SDMH#11
-------------------------

        User-Defined TOC override (minutes):      5.00

-------------------------
Subbasin LEVEE_SDMH#12
-------------------------

        User-Defined TOC override (minutes):      5.00

-------------------------
Subbasin LEVEE_SDMH#13
-------------------------

        User-Defined TOC override (minutes):      5.00

-------------------------
Subbasin LEVEE_SDMH#14
-------------------------

        User-Defined TOC override (minutes):      5.00

-------------------------
Subbasin LEVEE_SDMH#15
-------------------------

        User-Defined TOC override (minutes):      5.00

-------------------------
Subbasin LEVEE_SDMH#16
-------------------------

        User-Defined TOC override (minutes):      5.00

-------------------------
Subbasin LEVEE_SDMH#17
-------------------------

        User-Defined TOC override (minutes):      5.00

-------------------------
Subbasin LEVEE_SDMH#18
-------------------------

        User-Defined TOC override (minutes):      5.00

-------------------------
Subbasin LEVEE_SDMH#19
```

```
-------------------------

        User-Defined TOC override (minutes):      5.00

------------------------
Subbasin LEVEE_SDMH#4
------------------------

        User-Defined TOC override (minutes):      5.00

------------------------
Subbasin LEVEE_SDMH#5
------------------------

        User-Defined TOC override (minutes):      5.00

------------------------
Subbasin LEVEE_SDMH#6
------------------------

        User-Defined TOC override (minutes):      5.00

------------------------
Subbasin LEVEE_SDMH#7
------------------------

        User-Defined TOC override (minutes):      5.00

------------------------
Subbasin LEVEE_SDMH#8
------------------------

        User-Defined TOC override (minutes):      5.00

------------------------
Subbasin LEVEE_SDMH#9
------------------------

        User-Defined TOC override (minutes):      5.00

---------------------------
Subbasin Sub-EX. SDMH #11
---------------------------

        User-Defined TOC override (minutes):     15.00

---------------------------
Subbasin Sub-EX. SDMH #12
---------------------------

        User-Defined TOC override (minutes):     15.00

---------------------------
Subbasin Sub-EX. SDMH #13
---------------------------

        User-Defined TOC override (minutes):     15.00

---------------------------
Subbasin Sub-EX. SDMH #17
---------------------------

        User-Defined TOC override (minutes):     15.00

---------------------------
Subbasin Sub-EX. SDMH #4
---------------------------
```

User-Defined TOC override (minutes): 15.00

Subbasin Sub-EX_SDMH#20

User-Defined TOC override (minutes): 60.00

****
Subbasin Runoff Summary
****

Subbasin ID	Total Precip in	Total Runoff in	Peak Runoff cfs	Weighted Curve Number	Time of Concentration days	Time of Concentration hh:mm:ss
LEVEE_CB#1	3.44	3.21	0.10	98.000	0	00:05:00
LEVEE_CB#1_FOREST	3.44	1.31	0.47	76.000	0	00:15:00
LEVEE_CB#2	3.44	3.21	0.15	98.000	0	00:05:00
LEVEE_CB#2_FOREST	3.44	1.31	0.51	76.000	0	00:15:00
LEVEE_CB#3	3.44	3.21	0.07	98.000	0	00:05:00
LEVEE_CB#3_FOREST	3.44	1.31	0.38	76.000	0	00:15:00
LEVEE_CB#4	3.44	3.21	0.16	98.000	0	00:05:00
LEVEE_SDMH#10	3.44	3.21	0.13	98.000	0	00:05:00
LEVEE_SDMH#11	3.44	3.21	0.16	98.000	0	00:05:00
LEVEE_SDMH#12	3.44	3.21	0.10	98.000	0	00:05:00
LEVEE_SDMH#13	3.44	3.21	0.09	98.000	0	00:05:00
LEVEE_SDMH#14	3.44	3.21	0.19	98.000	0	00:05:00
LEVEE_SDMH#15	3.44	3.21	0.15	98.000	0	00:05:00
LEVEE_SDMH#16	3.44	3.21	0.15	98.000	0	00:05:00
LEVEE_SDMH#17	3.44	3.21	0.23	98.000	0	00:05:00
LEVEE_SDMH#18	3.44	3.21	0.15	98.000	0	00:05:00
LEVEE_SDMH#19	3.44	3.21	0.12	98.000	0	00:05:00
LEVEE_SDMH#4	3.44	3.21	0.14	98.000	0	00:05:00
LEVEE_SDMH#5	3.44	3.21	0.07	98.000	0	00:05:00
LEVEE_SDMH#6	3.44	3.21	0.10	98.000	0	00:05:00
LEVEE_SDMH#7	3.44	3.21	0.07	98.000	0	00:05:00
LEVEE_SDMH#8	3.44	3.21	0.03	98.000	0	00:05:00
LEVEE_SDMH#9	3.44	3.21	0.07	98.000	0	00:05:00
Sub-EX. SDMH #11	3.44	3.01	8.33	95.800	0	00:15:00
Sub-EX. SDMH #12	3.44	3.01	1.70	95.800	0	00:15:00
Sub-EX. SDMH #13	3.44	3.01	7.16	95.800	0	00:15:00
Sub-EX. SDMH #17	3.44	3.01	11.07	95.800	0	00:15:00
Sub-EX. SDMH #4	3.44	1.31	10.30	76.000	0	00:15:00
Sub-EX_SDMH#20	3.44	2.21	115.27	87.000	0	01:00:00

Curve Number for this Subbasin is manually input to match the known 25-year detention release rate from Freeman Logistics (1.0 cfs) combined with the 25-year release rate from Riverfront Industrial Park Phase 1&2 (±8 cfs), plus approx 15% factor of safety.

****
Node Depth Summary
****

Node ID	Average Depth Attained ft	Maximum Depth Attained ft	Maximum HGL Attained ft	Time of Max Occurrence days	Time of Max Occurrence hh:mm	Total Flooded Volume acre-in	Total Time Flooded minutes	Retention Time hh:mm:ss
EX. CB #1	0.18	0.39	33.39	0	08:01	0	0	0:00:00
EX. CB #2	0.26	0.63	33.23	0	08:05	0	0	0:00:00
EX. CB #3	0.32	0.84	32.91	0	08:06	0	0	0:00:00
EX. SDMH #10	0.68	3.00	34.70	0	08:09	0	0	0:00:00
EX. SDMH #11	1.10	3.34	34.31	0	08:08	0	0	0:00:00
EX. SDMH #12	0.78	2.87	33.61	0	08:07	0	0	0:00:00
EX. SDMH #13	0.86	3.15	33.42	0	08:07	0	0	0:00:00

EX. SDMH #14	1.00	3.47	32.89	0	08:07	0	0	0:00:00
EX. SDMH #15	1.04	3.47	32.28	0	08:07	0	0	0:00:00
EX. SDMH #16	1.03	3.41	31.80	0	08:07	0	0	0:00:00
EX. SDMH #17	1.18	3.36	31.25	0	08:06	0	0	0:00:00
EX. SDMH #18	1.10	2.81	30.08	0	08:07	0	0	0:00:00
EX. SDMH #19	1.07	2.68	29.35	0	08:07	0	0	0:00:00
EX. SDMH #20	3.25	4.54	28.63	0	08:10	0	0	0:00:00
EX. SDMH #4	0.51	1.38	35.65	0	08:10	0	0	0:00:00
EX. SDMH #5	0.61	1.75	35.48	0	08:10	0	0	0:00:00
EX. SDMH #6	0.59	1.94	35.31	0	08:10	0	0	0:00:00
EX. SDMH #7	0.67	2.40	35.14	0	08:10	0	0	0:00:00
EX. SDMH #8	0.65	2.50	35.04	0	08:10	0	0	0:00:00
EX. SDMH #9	0.61	2.68	34.92	0	08:09	0	0	0:00:00
EX.CB#4	0.35	0.84	32.48	0	08:05	0	0	0:00:00
Out-1Pipe - (62)	3.12	3.21	27.09	0	08:10	0	0	0:00:00

****
Node Flow Summary
****

Node ID	Element Type	Maximum Lateral Inflow cfs	Peak Inflow cfs	Time of Peak Inflow Occurrence days	hh:mm	Maximum Flooding Overflow cfs	Time of Peak Flooding Occurrence days	hh:mm
EX. CB #1	JUNCTION	0.56	0.56	0	08:00	0.00		
EX. CB #2	JUNCTION	0.64	1.20	0	08:01	0.00		
EX. CB #3	JUNCTION	0.45	1.63	0	08:04	0.00		
EX. SDMH #10	JUNCTION	0.13	10.94	0	08:18	0.00		
EX. SDMH #11	JUNCTION	8.48	17.77	0	08:12	0.00		
EX. SDMH #12	JUNCTION	1.80	19.31	0	08:11	0.00		
EX. SDMH #13	JUNCTION	7.24	25.93	0	08:08	0.00		
EX. SDMH #14	JUNCTION	0.19	26.10	0	08:09	0.00		
EX. SDMH #15	JUNCTION	0.15	26.21	0	08:09	0.00		
EX. SDMH #16	JUNCTION	0.15	26.33	0	08:09	0.00		
EX. SDMH #17	JUNCTION	11.29	36.95	0	08:06	0.00		
EX. SDMH #18	JUNCTION	0.15	37.08	0	08:06	0.00		
EX. SDMH #19	JUNCTION	0.12	37.11	0	08:06	0.00		
EX. SDMH #20	JUNCTION	115.27	153.37	0	08:10	0.00		
EX. SDMH #4	JUNCTION	10.41	10.41	0	08:06	0.00		
EX. SDMH #5	JUNCTION	0.07	10.43	0	08:06	0.00		
EX. SDMH #6	JUNCTION	0.10	10.39	0	08:02	0.00		
EX. SDMH #7	JUNCTION	0.07	10.22	0	08:01	0.00		
EX. SDMH #8	JUNCTION	0.03	10.43	0	08:14	0.00		
EX. SDMH #9	JUNCTION	0.07	10.62	0	08:17	0.00		
EX.CB#4	JUNCTION	0.16	1.76	0	08:04	0.00		
Out-1Pipe - (62)	OUTFALL	0.00	153.37	0	08:10	0.00		

****
Outfall Loading Summary
****

Outfall Node ID	Flow Frequency (%)	Average Flow cfs	Peak Inflow cfs
Out-1Pipe - (62)	98.23	52.57	153.37
System	98.23	52.57	153.37

****
Link Flow Summary

****


Link ID	Element Type	Time of Peak Flow Occurrence days hh:mm	Maximum Velocity Attained ft/sec	Length Factor	Peak Flow during Analysis cfs	Design Flow Capacity cfs	Ratio of Maximum /Design Flow	Ratio of Maximum Depth	Total Time minutes	Reported Condition
Pipe - (43)	CONDUIT	0 08:06	3.79	1.00	10.37	31.84	0.33	0.63	0	Calculated
Pipe - (44)	CONDUIT	0 08:02	3.57	1.00	10.30	22.15	0.47	0.74	0	Calculated
Pipe - (45)	CONDUIT	0 08:01	3.34	1.00	10.16	22.29	0.46	0.87	0	Calculated
Pipe - (46)	CONDUIT	0 08:14	3.11	1.00	10.41	22.29	0.47	0.98	0	Calculated
Pipe - (47)	CONDUIT	0 08:17	3.30	1.00	10.58	22.28	0.47	1.00	1	SURCHARGED
Pipe - (48)	CONDUIT	0 08:18	3.28	1.00	10.87	20.80	0.52	1.00	15	SURCHARGED
Pipe - (49)	CONDUIT	0 08:18	2.76	1.00	10.98	15.27	0.72	1.00	21	SURCHARGED
Pipe - (50)	CONDUIT	0 08:12	3.62	1.00	17.77	19.87	0.89	1.00	15	SURCHARGED
Pipe - (51)	CONDUIT	0 08:12	3.69	1.00	19.51	44.94	0.43	0.98	0	Calculated
Pipe - (52)	CONDUIT	0 08:09	4.25	1.00	25.96	42.13	0.62	1.00	9	SURCHARGED
Pipe - (53)	CONDUIT	0 08:09	3.69	1.00	26.10	32.31	0.81	1.00	19	SURCHARGED
Pipe - (54)	CONDUIT	0 08:09	3.71	1.00	26.22	32.56	0.81	1.00	21	SURCHARGED
Pipe - (55)	CONDUIT	0 08:09	3.73	1.00	26.34	32.31	0.82	1.00	21	SURCHARGED
Pipe - (56)	CONDUIT	0 08:06	5.28	1.00	36.96	32.31	1.14	0.97	0	> CAPACITY
Pipe - (57)	CONDUIT	0 08:06	4.59	1.00	37.01	48.74	0.76	0.78	0	Calculated
Pipe - (58)	CONDUIT	0 08:07	4.90	1.00	37.08	54.37	0.68	0.74	0	Calculated
Pipe - (59)	CONDUIT	0 08:01	1.42	1.00	0.56	1.77	0.31	0.51	0	Calculated
Pipe - (60)	CONDUIT	0 08:04	1.96	1.00	1.18	1.77	0.67	0.74	0	Calculated
Pipe - (61)	CONDUIT	0 08:05	3.00	1.00	1.76	1.77	0.99	0.70	0	Calculated
Pipe - (62)	CONDUIT	0 08:10	7.02	1.00	153.37	168.82	0.91	0.55	0	Calculated
Pipe - (63)	CONDUIT	0 08:06	2.31	1.00	1.62	1.77	0.92	0.84	0	Calculated

****
Highest Flow Instability Indexes
****
All links are stable.

WARNING 005 : Minimum slope used for Conduit Pipe - (50).
WARNING 005 : Minimum slope used for Conduit Pipe - (53).

```
WARNING 005 : Minimum slope used for Conduit Pipe - (55).
WARNING 005 : Minimum slope used for Conduit Pipe - (56).
WARNING 005 : Minimum slope used for Conduit Pipe - (57).
WARNING 005 : Minimum slope used for Conduit Pipe - (62).

Analysis began on:  Tue Jun 17 14:18:56 2025
Analysis ended on:  Tue Jun 17 14:18:57 2025
Total elapsed time: 00:00:01
```

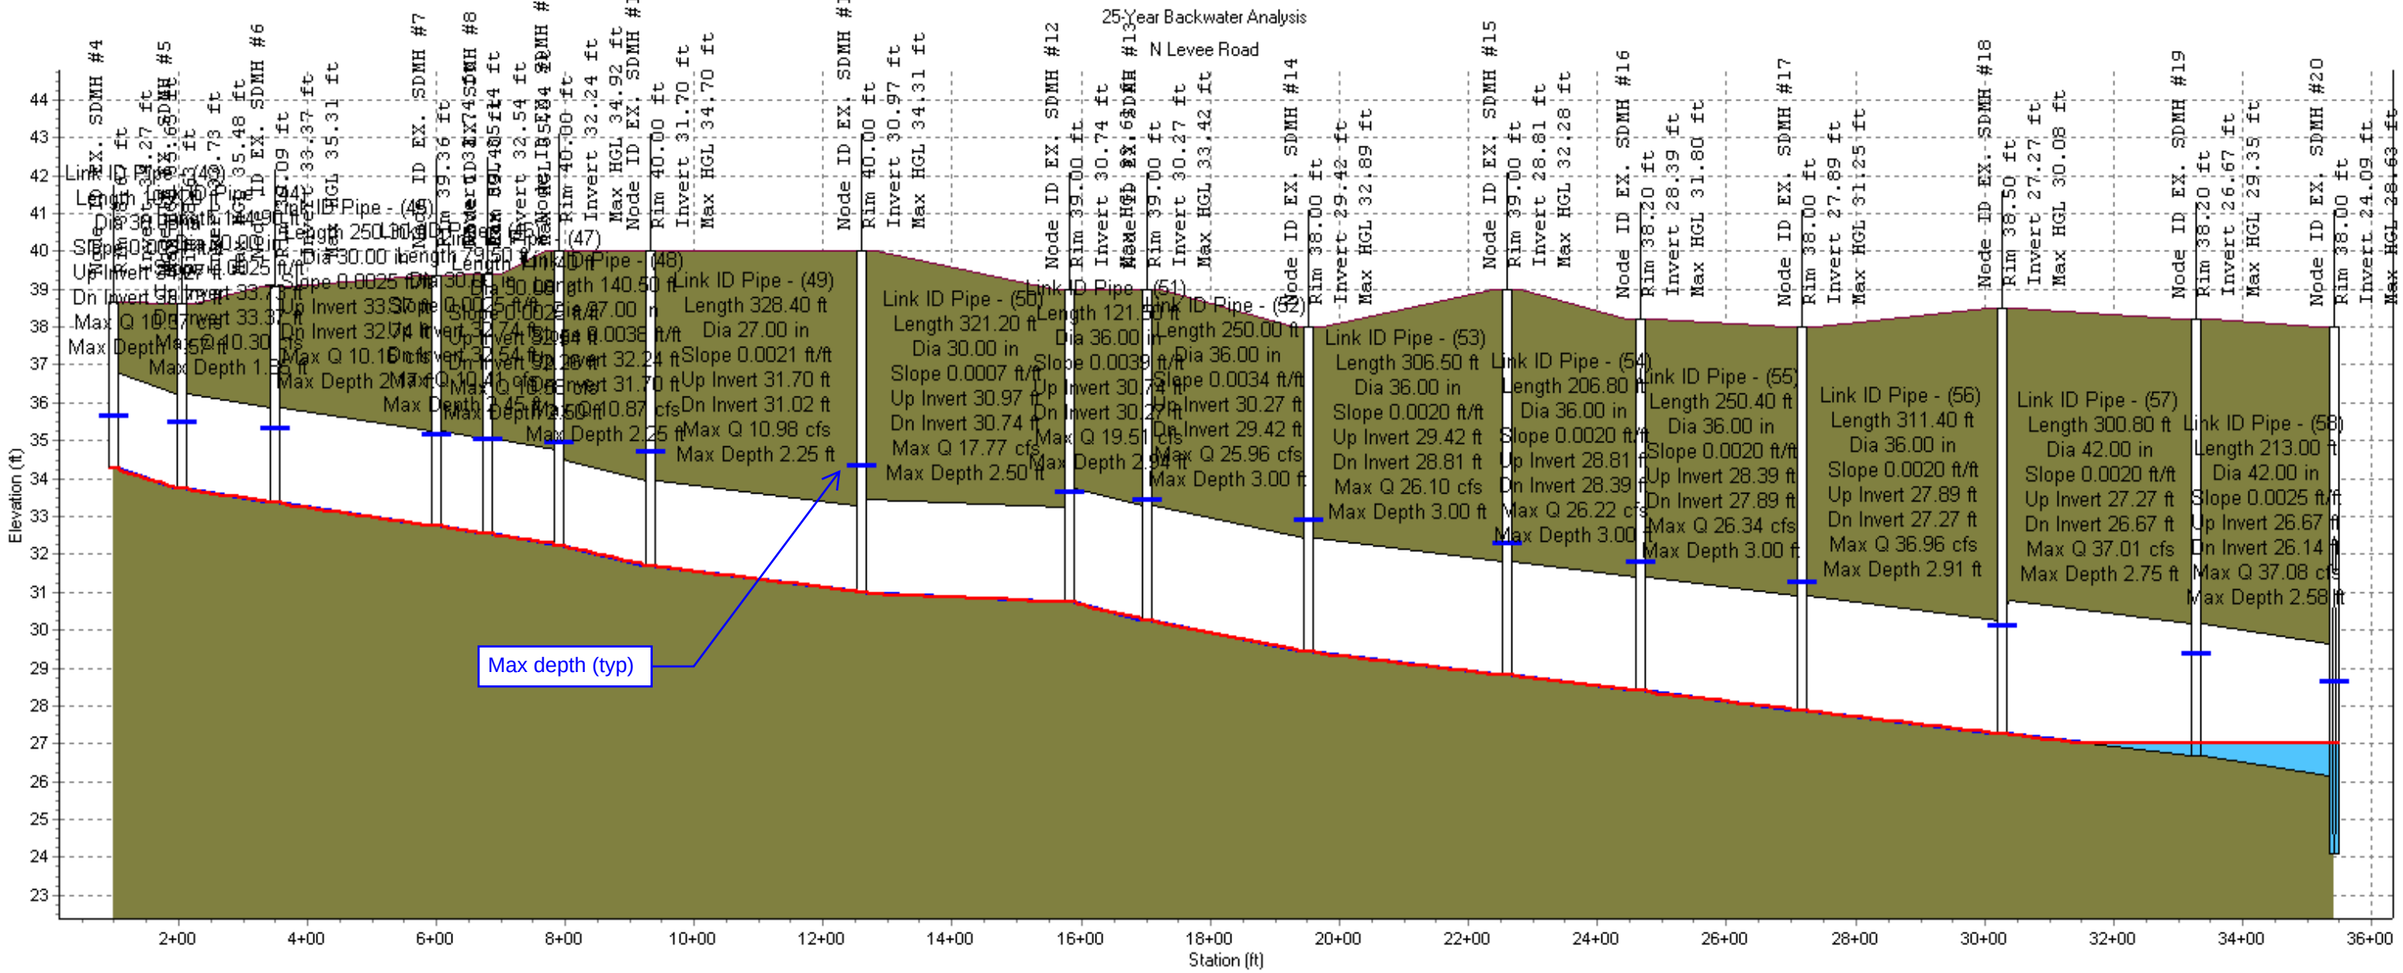

Node ID:	EX. SDMH #4	EX. SDMH #5	EX. SDMH #6	EX. SDMH #7	EX. SDMH #8	EX. SDMH #9	EX. SDMH #10	EX. SDMH #11	EX. SDMH #12	EX. SDMH #13	EX. SDMH #14	EX. SDMH #15	EX. SDMH #16	EX. SDMH #17	EX. SDMH #18	EX. SDMH #19	EX. SDMH #20
Rim (ft):	38.67	38.63	39.09	39.36	39.40	40.00	40.00	40.00	39.00	39.00	38.00	39.00	38.20	38.00	38.50	38.20	38.00
Invert (ft):	34.27	33.73	33.37	32.74	32.54	32.24	31.70	30.97	30.74	30.27	29.42	28.81	28.39	27.89	27.27	26.67	24.09
Min Pipe Cover (ft):	1.90	2.40	3.22	4.12	4.36	5.24	6.05	6.53	5.26	5.73	5.58	7.19	6.81	7.11	7.73	8.03	5.54
Max HGL (ft):	35.65	35.48	35.31	35.14	35.04	34.92	34.70	34.31	33.61	33.42	32.89	32.28	31.80	31.25	30.08	29.35	28.63

Link ID:	Pipe - (43)	Pipe - (44)	Pipe - (45)	Pipe - (46)	Pipe - (47)	Pipe - (48)	Pipe - (49)	Pipe - (50)	Pipe - (51)	Pipe - (52)	Pipe - (53)	Pipe - (54)	Pipe - (55)	Pipe - (56)	Pipe - (57)	Pipe - (58)
Length (ft):	105.20	144.90	250.30	79.50	111.40	140.50	328.40	321.20	121.50	250.00	306.50	206.80	250.40	311.40	300.80	213.00
Dia (in):	30.00	30.00	30.00	30.00	30.00	27.00	27.00	30.00	36.00	36.00	36.00	36.00	36.00	36.00	42.00	42.00
Slope (ft/ft):	0.0051	0.0025	0.0025	0.0025	0.0025	0.0038	0.0021	0.0007	0.0039	0.0034	0.0020	0.0020	0.0020	0.0020	0.0020	0.0025
Up Invert (ft):	34.27	33.73	33.37	32.74	32.54	32.24	31.70	30.97	30.74	30.27	29.42	28.81	28.39	27.89	27.27	26.67
Dn Invert (ft):	33.73	33.37	32.74	32.54	32.26	31.70	31.02	30.74	30.27	29.42	28.81	28.39	27.89	27.27	26.67	26.14
Max Q (cfs):	10.37	10.30	10.16	10.41	10.58	10.87	10.98	17.77	19.51	25.96	26.10	26.22	26.34	36.96	37.01	37.08
Max Vel (ft/s):	3.79	3.57	3.34	3.11	3.30	3.28	2.76	3.62	3.69	4.25	3.69	3.71	3.73	5.28	4.59	4.90
Max Depth (ft):	1.57	1.85	2.17	2.45	2.50	2.25	2.25	2.50	2.94	3.00	3.00	3.00	3.00	2.91	2.75	2.58

OFFSITE ANALYSIS PHOTO EXHIBIT

Photo Exhibit



Photo 1. Looking north from the SE property corner. Existing farmland is flat. There is no concentrated discharge point from this portion of the site.



Photo 2. Looking northwest toward the north, central portion of the site. Stormwater appears to drain in a general NW direction within this part of the site.



Photo 3. Looking north at the NW site corner during heavy rain event. Stormwater collects in this corner and passes under Freeman Rd within a 12-inch concrete culvert.



Photo 4. Looking north along roadside ditch on the west side of Freeman Rd opposite the north end of the site.



Photo 5. Looking west along ditch on the west side of Freeman Rd where the roadside ditch joins the larger agricultural ditch and then heads west.



Photo 6. Photo of the agricultural ditch during dry season.



Photo 7. Portion of oxbow wetland observed during peak rain event at the beginning of March 2022. No flooding of the wetland or related conveyance elements was observed during this period.



Photo 8. Located northwest of the intersection of Freeman Rd E and N Levee Rd, facing northwest. The vacant parcel is lower in elevation than the surrounding area and heavily vegetated.

Tab 5.0

5.0 PERMANENT STORMWATER CONTROL PLAN

5.0 PERMANENT STORMWATER CONTROL PLAN

Part A Existing Site Hydrology

Under existing conditions, the site is an assemblage of parcels which contain single family homes plus minimally developed pasture and farmland. The homes are mostly concentrated in the middle of the site and along the southwestern border. Per the geotechnical report prepared for the project, the soil on site is alluvial type loamy to sandy loam. The soil has minimal infiltration potential. The project site has a high-water table, approximately 2-9 feet below the existing grade, varying with the season and location. Site grades are minimal, however the overall trend is a gradual slope of less than 1% to the north. Vegetation is predominantly pasture in the north, prior crop use in the south, plus a few scattered trees and lawn adjacent the single-family homes. Runoff from the site appears to travel via sheet flow and shallow subsurface interflow toward the northwest corner. There are no existing manmade structures to collect and convey runoff onsite. Freeman Road is higher than the site and causes drainage to pond during heavy rain events and then runs north. There exists a shallow 12" concrete culvert in the northwest site corner where stormwater is conveyed offsite under Freeman Road to the west. See Section 4.0 for a more detailed analysis of the downstream system. The onsite area totals 24.05 acres, which is divided north and south by 22nd Ave NW. An additional 2.67 acres of existing plus proposed public ROW area along the project frontage on Freeman Road East and 22nd Ave NW will receive improvements. The north end of Freeman Road, north of 48th Street, is tributary to a roadside ditch. The onsite plus frontage areas total 26.30 acres.

A separate offsite area to the south of the parcels, at the Freeman and Levee Road intersection, is also part of the project. Road widening and ROW dedication is proposed at the northwest intersection corner to accommodate truck and trailer traffic to and from the development. The dedication area is contained on a single parcel which is undeveloped and forested. Part of the existing road shoulder to be widened is gravel covered. Road drainage is currently uncollected and is dispersed to the road shoulder. Stormwater is presumed to infiltrate (see Section 4). This offsite area is considered a separate basin. See part B for areas.

Converted surfaces for this project are considered forested in the pre-developed modeling condition for all basins.

Part B Developed Site Hydrology

The developed site will include two commercial warehouse buildings with dock high loading, associated parking and drive aisles, storm drainage facilities, utilities, landscaping and frontage improvements. The impervious coverage after development will be approximately 80%, including frontage improvements. Flow control and water quality facilities are proposed to mitigate stormwater runoff from the new plus replaced impervious surfaces and landscape.

The parcel area and adjacent frontage improvements of the site are contained within a single drainage basin. However, due to the configuration of the site plan, the public ROW of 22nd Ave NW divides the site into two halves, north and south. Stormwater mitigation is handled separately for private versus public runoff. Therefore, the private improvements include separate collection and detention facilities for the north and south buildings. An additional facility is designed to mitigate the public roadway stormwater. Mitigated stormwater is then collected to a central lift station and pumped offsite to the existing system along N Levee Road as described in part F of this section.

The frontage improvements along Freeman Road include significant road widening, curb, sidewalk, landscape, pavement replacement and storm drainage system. Stormwater runoff flows will increase due to the increased pavement surface area. The majority of runoff will be collected using curbing to direct flows to catch basins and underground storm pipes, then to a proposed detention vault. The collected surfaces along the frontage include 108,589 proposed new impervious area and 11,049 sf of landscape. With the addition of the 48th St E alternative utility routing, the total new impervious area

increases to a total of 136,866 square feet.

The offsite frontage improvements include a portion of Freeman Road between 19th Ave NW and N Levee Road, plus revisions to the intersection. Improvements include road widening to install turn pockets, curb, lighting, pavement replacement, pavement overlay and storm drainage system. An open biofiltration pond is proposed to the northeast of the intersection, to treat collected stormwater and infiltrate to native soils. The total of new plus replaced impervious area is 43,702 sf for the offsite basin.

A breakdown of developed site areas is provided in the below table:

DEVELOPED SITE AREAS		(sf)		(ac)
North Parcel				
Building (roof)	237,615		5.45	
Asphalt	135,854		3.12	
Sidewalk	26,299		0.60	
Landscape	70,130		1.61	
South Parcel				
Building (roof)	266,408		6.12	
Asphalt	126,514		2.90	
Sidewalk	43,669		1.00	
Landscape	79,032		1.81	
Frontage ROW				
Asphalt	91,632		2.10	
Sidewalk	13,329		0.31	
Landscape	11,289		0.26	
Offsite ROW				
Asphalt	43,441		1.00	
Lawn	209		0.01	
Sidewalk	261		0.01	
Total				
Building (roof)	504,023		11.57	
Asphalt	397,441		9.12	
Sidewalk	83,558		1.92	
Landscape	160,660		3.69	

Please refer to the later sections of this report for the sizing calculations for the flow control and water quality facilities.

Part C Performance Standards and Goals

This stormwater site plan is prepared in accordance with the 2019 Department of Ecology Stormwater Manual for Western Washington, as adopted by the City of Puyallup and City of Fife. The standard flow control criteria (50% of the 2-year, up to the full 50-yr duration matching) is applicable. Enhanced water quality treatment is required due to commercial site use. A feasibility analysis is required for implementation of LID BMPs.

Low Impact Development Features

This development triggers all the minimum requirements, including Minimum Requirement #5 – On-site Stormwater Management. To meet this requirement, the LID List Approach is used. See below for the feasibility analysis of each BMP.

- Lawn and Landscaped Areas
  - Post-Construction Soil Quality and Depth (BMP T5.13)
    - This BMP is feasible and will be used to the greatest extent possible.
- Roof Areas
  - Full dispersion
    - Full dispersion has been determined to be infeasible for this project due to the project site being within a mapped floodplain, per Pierce County GIS.
  - Downspout Full Infiltration
    - Downspout full infiltration has been determined to be infeasible for this project due to the lack of clearance from the seasonal high groundwater table. See the geotechnical report, included as a separate document in this submittal.
  - Bioretention
    - Bioretention has been determined to be infeasible for the onsite area due to the project site being within a mapped floodplain, per Pierce County GIS. Furthermore, bioretention facilities would not be able to have sufficient clearance from the seasonal high groundwater table.
  - Downspout Dispersion
    - Downspout dispersion has been determined to be infeasible for this project due to the project site being within a mapped floodplain, per Pierce County GIS.
  - Perforated Stub-Out Connections
    - Perforated stub-out connections have been determined to be infeasible for this project due to the lack of clearance from the seasonal high groundwater table.
- Other hard surfaces
  - Full Dispersion
    - Full dispersion has been determined to be infeasible for this project due to the project site being within a mapped floodplain, per Pierce County GIS.
  - Permeable Pavement
    - Permeable pavement has been determined to be infeasible due to the lack of sufficient strength to support the anticipated truck traffic.
  - Bioretention
    - Bioretention has been determined to be feasible for the offsite road improvements near the intersection of Freeman Road E and N Levee Rd. The proposed bioretention/infiltration facility has sufficient clearance from the seasonal high ground water table elevation and the soils have sufficient infiltration capacity. This facility also provides full infiltration of tributary stormwater. Onsite hard surfaces cannot utilize this BMP due to limited clearance from seasonal high groundwater elevation.
  - Sheet Flow/Concentrated Dispersion
    - Both sheet flow and concentrated dispersion have been determined to be infeasible for this project due to the project site being within a mapped floodplain, per Pierce County GIS.

Part D Flow Control System

WWHM was used to size four separate flow control facilities to serve the various target surface areas of the project. Two large underground detention vaults are designed for the main north and south building sites, serving the runoff from the private rooftop and parking areas. A third underground detention vault is designed within the ROW of 22nd Ave NW to provide flow control for the public Freeman Road, 22nd Ave and (if required) 48th St E frontage improvements, which are mitigated separate from onsite stormwater. Each vault is designed using a gravity-controlled flow restrictor device to regulate the release rate of stormwater in accordance with the flow control standard. A biofiltration/infiltration facility is proposed to mitigate flows from the impervious area added by the project between 19th Ave NW and N. Levee Road. This facility is designed for full infiltration of tributary runoff. Catch basins and pipes collect and direct flows to each respective flow control facility. Preliminary dimensions are provided in the table below.

Facility Name	Length (FT)	Width (FT)	Depth (FT)	Volume Provided (CF)	Volume Required per WWHM
Building A Vault	360	100	7.5	234,000	230,750
Building B Vault	350	120	7.5	273,000	261,300
22nd Ave Vault	308	20	11.5	64,680	61,420
Levee Road Biofiltration Pond	Varies	Varies	3.5	15,011	14,675

The three vault facilities are located north of 19th Ave NW and are within the same basin. However, due to topography constraints, a gravity discharge to a downstream drainage course is not feasible. Mitigated flows from the three vaults are designed to convey to a central lift station facility. The lift station pumps runoff via force main to the offsite downstream connection point, located near Industrial Parkway on N Levee Road.

The lift station is designed with a wet well and 2-4 pumps with variable speed controls. The controls allow a wide range of flow adjustment to closely match the discharge rate of stormwater leaving the detention vaults. The preliminary control system includes multiple float switches, a variable frequency drive (VFD), and a pressure transducer to adjust the motor speed and/or turn on additional pumps to keep a consistent water level in the wet well. As a result, during the critical design storm range (50% of the 2-year peak up to the 100-year peak flow), the lift station will allow the control structure of each vault to operate normally via gravity such that the project impact at the point of compliance meets the flow control standard. See attached pump details in this section.

The Levee Road biofiltration facility is within a separate basin. The proposed design includes an open pond with lining of bioretention media to treat stormwater. The underlying native soils have a design infiltration rate of 1.5 inches per hour per Terra Associates. The pond size provided allows treated stormwater to fully infiltrate up to the 100-year storm event.

Part E Water Quality System

Water quality treatment is designed to mitigate stormwater from target pollution-generating impervious surfaces. Enhanced treatment is provided for the onsite surface areas and the adjacent frontage improvements using underground proprietary vaults located downstream of each of the three detention vaults. Enhanced water quality treatment is also designed for offsite improvements between 19th Ave NW and N. Levee Road using biofiltration media within the pond bottom. Each facility is designed using WWHM using the appropriate water quality design flow rate. Additional details will be provided during final engineering.

Part F Conveyance System Analysis and Design

The onsite conveyance system will be sized for the 25-year storm event without flooding. The rational method will be used to size all conveyance pipes. This analysis will be completed for engineering permitting.


Refer to the attached pump calculations at the end of this section. Collected stormwater is routed through the proposed detention vaults and then through water quality facilities providing enhanced treatment. Following treatment, water is conveyed to a lift station, located near the southwest corner of building A. The lift station houses a duplex pump system that conveys water south along the eastern portion of Freeman Road until it turns easterly along N Levee Road. The pump discharge line continues east along N Levee Road until it turns north and ties into an existing manhole near the intersection of N Levee Road and Industrial Parkway. See the civil plans for more details. The lift station and force main are proposed as public facilities to be owned and maintained by the City of Puyallup.

GRADING AND STORM DRAINAGE PLAN

PRELIMINARY STORM DRAINAGE OVERALL PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 100' 200' 400'
SCALE: 1"=200'

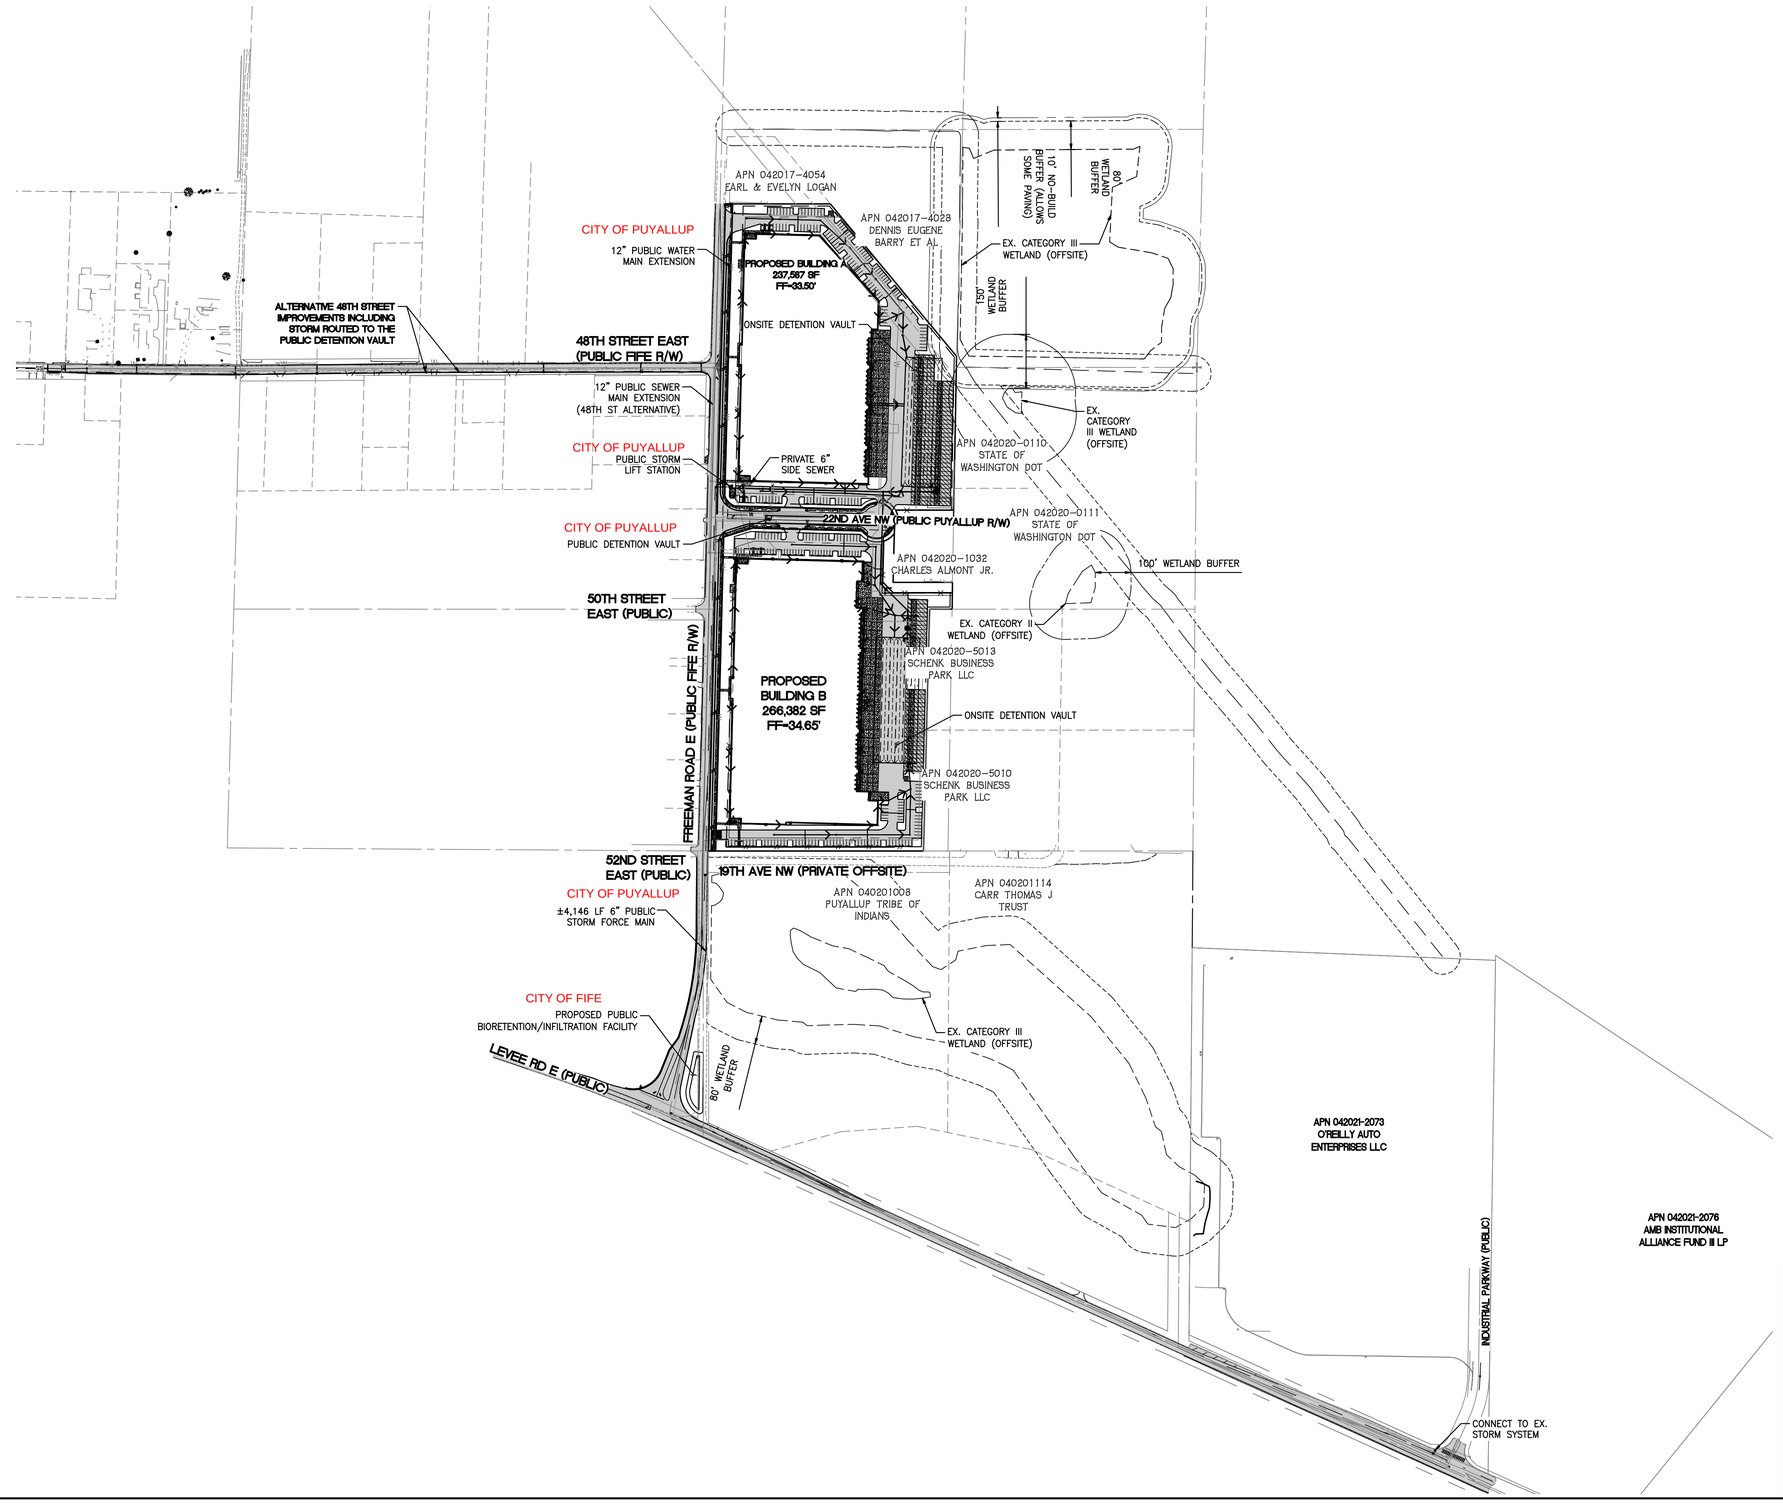

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	06/02/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title:
PRELIMINARY STORM DRAINAGE OVERALL PLAN
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCABEE
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
6/3/25

Scale: Horizontal 1"=200' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 6/3/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Job Number 21585

Sheet C7 of 48


P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 6/3/2025 12:21 PM DCASEY

PRELIMINARY GRADING AND DRAINAGE PLAN

OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

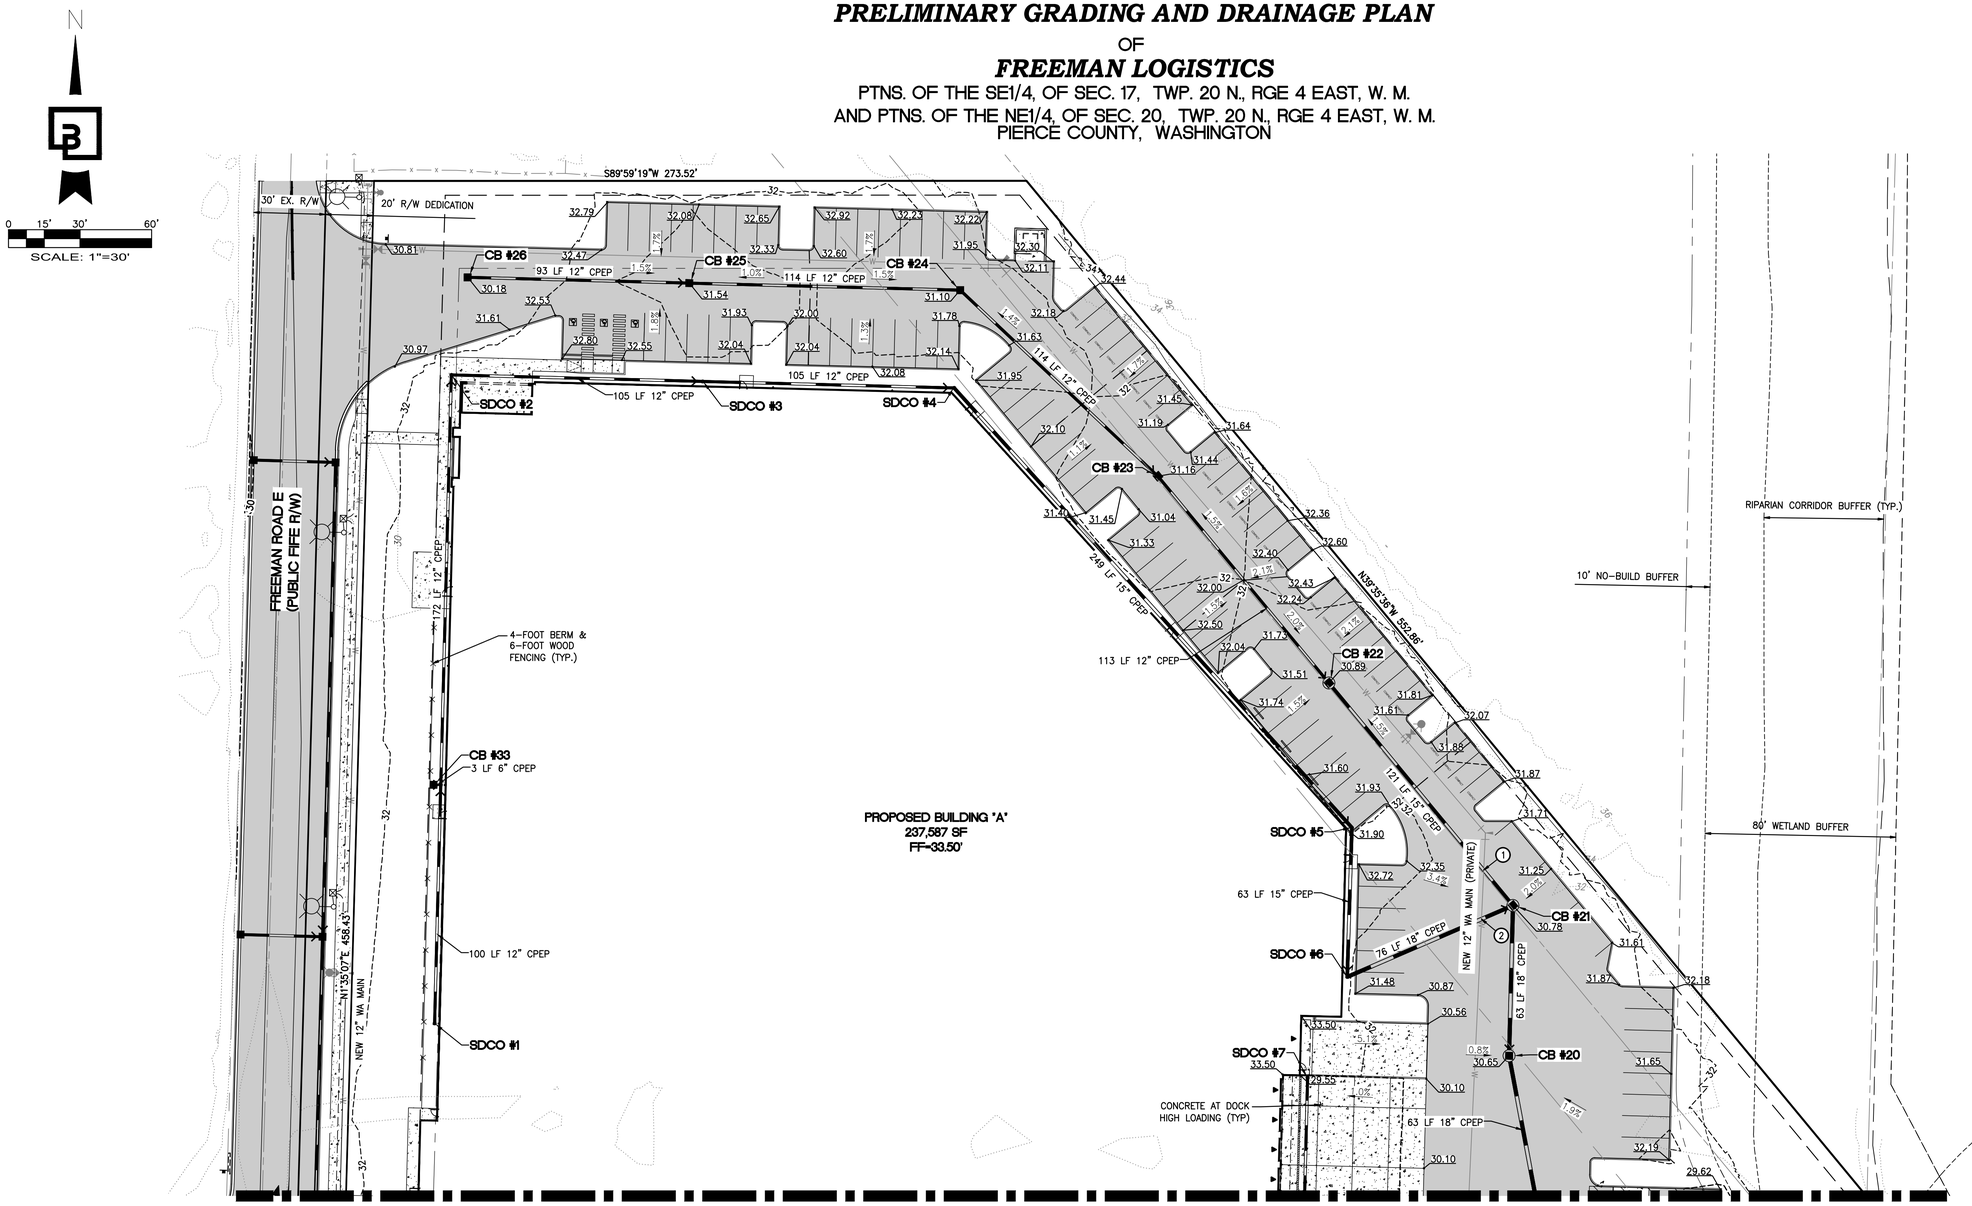

MATCHLINE- SEE SHEET C9 FOR CONTINUATION

CATCH BASINS
CB #20, TYPE 2-48" W/STANDARD GRATE RIM=30.65 IE=24.03 (18" N) IE=24.03 (18" S)
CB #21, TYPE 2-48" W/STANDARD GRATE RIM=30.78 IE=24.78 (15" NW) IE=24.53 (18" SW) IE=24.53 (18" S)
CB #22, TYPE 2-48" W/STANDARD GRATE RIM=30.89 IE=25.74 (12" NW) IE=25.49 (15" SE)
CB #23, TYPE 1, W/STANDARD GRATE RIM=31.16 IE=26.38 (12" NW) IE=26.38 (12" SE)
CB #24, TYPE 1, W/STANDARD GRATE RIM=31.10 IE=26.95 (12" W) IE=26.95 (12" SE)
CB #25, TYPE 1, W/STANDARD GRATE RIM=31.54 IE=27.52 (12" W) IE=27.52 (12" E)
CB #26, TYPE 1, W/STANDARD GRATE RIM=30.18 IE=27.98 (12" E)
CB #33, TYPE 1, W/STANDARD GRATE RIM=33.18 IE=30.90 (6" E)
SDCO #1, 8" SDCO RIM=33.40 IE=31.00 (12" N)
SDCO #2, 8" SDCO RIM=33.22 IE=28.98 (12" S) IE=28.98 (12" E)
SDCO #3, 8" SDCO RIM=32.21 IE=28.19 (12" W) IE=28.19 (12" E)
SDCO #4, 8" SDCO RIM=32.61 IE=27.41 (12" W) IE=27.16 (15" SE)
SDCO #5, 8" SDCO RIM=31.89 IE=25.56 (15" NW) IE=25.56 (15" S)
SDCO #6, 8" SDCO RIM=32.28 IE=25.09 (15" N) IE=24.84 (18" NE)
SDCO #7, 8" SDCO RIM=29.58 IE=27.20 (12" S)
SDCO #37, 8" SDCO RIM=33.38 IE=30.26 (12" S) IE=30.76 (6" W) IE=30.26 (12" N)

UTILITY CROSSING TABLE					
#	BOTTOM UTILITY	TOP	TOP UTILITY	BOTTOM	CLEAR (FT)
1	15" STORM	26.00	12" WATER	27.00	1.00
2	18" STORM	26.00	12" WATER	27.00	1.00

UTILITY CROSSING NOTE:

CONTRACTOR SHALL MAINTAIN MINIMUM VERTICAL SEPARATION BETWEEN UTILITIES AS REQUIRED BY JURISDICTIONS HAVING AUTHORITY. CONTRACTOR TO VERIFY SEPARATION REQUIREMENTS PRIOR TO CONSTRUCTION AND NOTIFY ENGINEER OF ANY DISCREPANCIES.

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	06/02/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title:
PRELIMINARY GRADING AND DRAINAGE PLAN
FOR
FREEMAN LOGISTICS

For:
VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCREL
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
6/3/25

Scale: Horizontal 1"=30' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 6/3/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Job Number 21585

Sheet C8 of 48


P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 6/3/2025 12:21 PM DCASEY

PRELIMINARY GRADING AND DRAINAGE PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 15' 30' 60'
SCALE: 1"=30'

MATCHLINE- SEE SHEET C8 FOR CONTINUATION

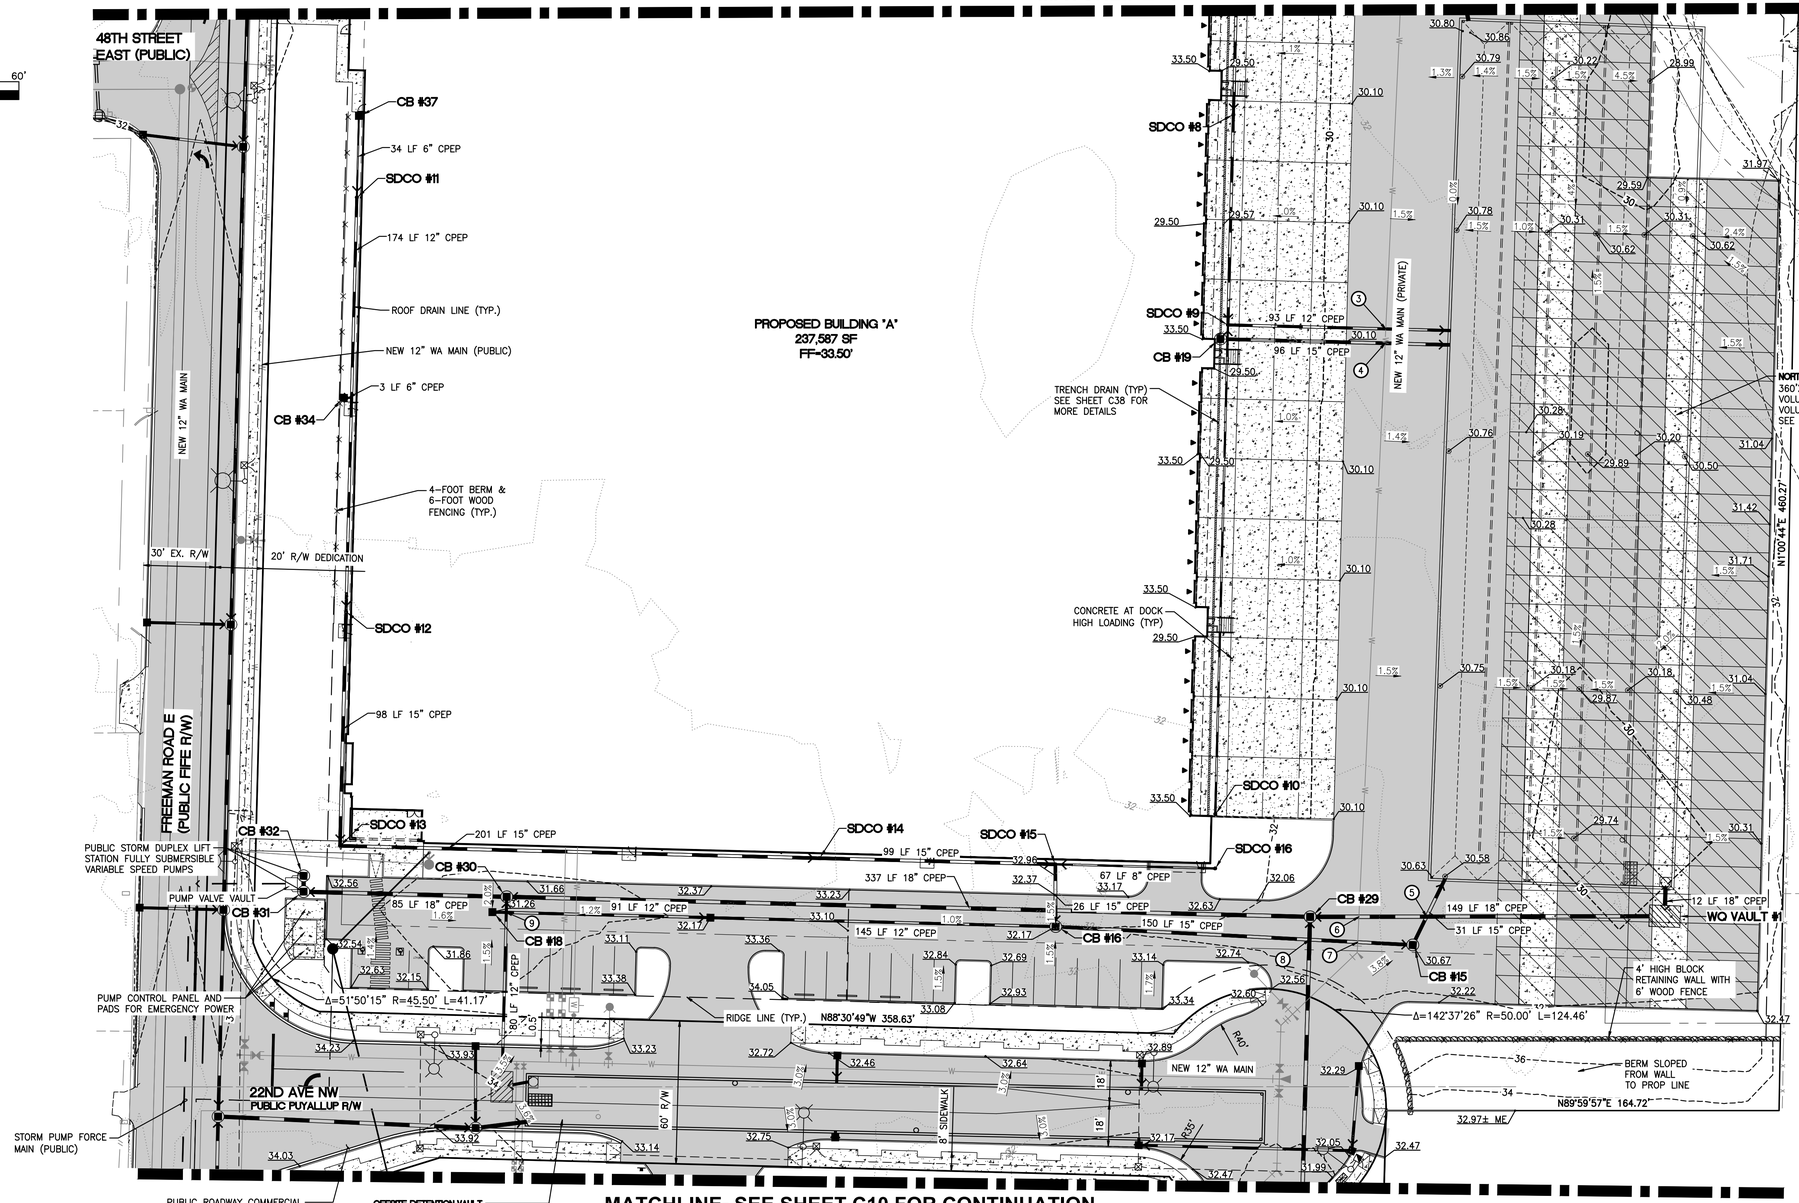

MATCHLINE- SEE SHEET C10 FOR CONTINUATION

CATCH BASINS
CB #15, TYPE 2-48", W/STANDARD GRATE RIM=30.67 IE=24.96 (15" W) IE=24.96 (15" NE)
CB #16, TYPE 2-48" W/STANDARD GRATE RIM=32.17 IE=27.22 (12" W) IE=26.97 (15" N) IE=26.97 (15" E)
CB #17, TYPE 1, W/STANDARD GRATE RIM=32.17 IE=27.94 (12" W) IE=27.94 (12" E)
CB #18, TYPE 1, W/STANDARD GRATE RIM=31.26 IE=28.40 (12" E)
CB #19, TYPE 2-48" W/STANDARD GRATE RIM=29.52 IE=24.00 (15" E)
CB #29, TYPE 2-48" W/SOLID LOCKING LID RIM=31.21 IE=17.18 (18" S) IE=17.18 (18" E) IE=17.18 (18" W)
CB #30, TYPE 2-48", W/STANDARD GRATE RIM=31.45 IE=14.92 (18" E) IE=15.38 (12" S) IE=13.42 (18" W)
CB #31, TYPE 2-54" W/SOLID LOCKING LID RIM=33.15 IE=12.99 (18" E) IE=12.99 (18" N)
CB #32, TYPE 2-54" W/SOLID LOCKING LID RIM=33.15 IE=12.99 (18" S)
CB #34, TYPE 1, W/STANDARD GRATE RIM=33.42 IE=31.33 (6" E)
CB #37, TYPE 1, W/STANDARD GRATE RIM=33.46 IE=31.75 (6" S)
SDCO #8, 8" SDCO RIM=29.57 IE=26.46 (12" N) IE=26.46 (12" S)
SDCO #9, 8" SDCO RIM=29.57 IE=26.08 (8" S) IE=25.75 (12" N) IE=25.75 (12" E)
SDCO #10, 8" SDCO RIM=29.59 IE=27.20 (8" N)
SDCO #11, 8" SDCO RIM=33.40 IE=31.50 (6" N) IE=31.00 (12" S)
SDCO #12, 8" SDCO RIM=33.50 IE=30.00 (12" N) IE=29.75 (15" S)
SDCO #13, 8" SDCO RIM=33.26 IE=29.17 (15" N) IE=29.17 (15" E)
SDCO #14, 8" SDCO RIM=33.36 IE=27.98 (15" W) IE=27.98 (15" E)
SDCO #15, 8" SDCO RIM=33.33 IE=27.39 (15" W) IE=27.97 (8" E) IE=27.39 (15" S)
SDCO #16, 8" SDCO RIM=33.33 IE=29.00 (8" W)
WQ VAULT #1, 6'X12' VAULT RIM=30.19 IE=20.29 (18" N) IE=18.12 (18" W)

UTILITY CROSSING TABLE

#	BOTTOM UTILITY	TOP	TOP UTILITY	BOTTOM	CLEAR (FT)
3	12" STORM	26.25	12" WATER	27.25	1.00
4	15" STORM	26.25	12" WATER	27.25	1.00
5	18" STORM	20.00	15" STORM	24.90	4.90
6	18" STORM	19.80	12" WATER	26.50	6.70
7	15" STORM	26.33	12" WATER	27.33	1.00
8	18" STORM	18.75	15" STORM	26.40	7.65
9	12" STORM	16.40	12" STORM	24.30	7.90

UTILITY CROSSING NOTE:
CONTRACTOR SHALL MAINTAIN MINIMUM VERTICAL SEPARATION BETWEEN UTILITIES AS REQUIRED BY JURISDICTIONS HAVING AUTHORITY. CONTRACTOR TO VERIFY SEPARATION REQUIREMENTS PRIOR TO CONSTRUCTION AND NOTIFY ENGINEER OF ANY DISCREPANCIES.

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	06/02/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY GRADING AND DRAINAGE PLAN**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCREE
STATE OF WASHINGTON
54927
REGISTERED PROFESSIONAL ENGINEER
6/3/25

Scale: Horizontal 1"=30' Vertical N/A
Designed JSM Drawn DTC Checked JSM Approved JSM Date 6/3/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585
Sheet C9 of 48

P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 6/3/2025 12:21 PM DCASEY


PRELIMINARY GRADING AND DRAINAGE PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 15' 30' 60'
SCALE: 1"=30'

CATCH BASINS
CB #8, TYPE 1, W/STANDARD GRATE RIM=31.04 IE=26.85 (12" W)
CB #9, TYPE 2-54" W/STANDARD GRATE RIM=30.95 IE=25.37 (18" NW) IE=25.98 (12" W) IE=26.06 (12" E) IE=25.37 (18" S)
CB #10, TYPE 1, W/STANDARD GRATE RIM=30.69 IE=27.98 (8" W) IE=27.65 (12" E)
CB #11, TYPE 2-48" W/STANDARD GRATE RIM=31.95 IE=26.48 (12" N) IE=26.23 (15" W) IE=25.98 (18" SE)
CB #12, TYPE 1, W/STANDARD GRATE RIM=31.44 IE=27.04 (12" W) IE=27.04 (12" S)
CB #13, TYPE 1, W/STANDARD GRATE RIM=31.84 IE=28.26 (12" E)
CB #27, TYPE 2-48" W/SOLID LOCKING LID RIM=31.43 IE=18.65 (18" S) IE=18.65 (18" NW)
CB #28, TYPE 2-48" W/SOLID LOCKING LID RIM=32.23 IE=18.26 (18" SE) IE=18.26 (18" N)
CB #35, TYPE 1, W/STANDARD GRATE RIM=34.77 IE=31.33 (6" E)
CB #38, TYPE 1, W/STANDARD GRATE RIM=34.53 IE=32.33 (6" N)
CB #41, TYPE 1, W/STANDARD GRATE RIM=34.38 IE=31.00 (6" NE)
SDCO #17, 8" SDCO RIM=34.60 IE=32.05 (6" S) IE=31.55 (12" N)
SDCO #18, 8" SDCO RIM=34.48 IE=30.73 (12" S) IE=30.48 (15" N)
SDCO #19, 8" SDCO RIM=34.42 IE=29.87 (15" S) IE=30.62 (6" SW) IE=29.87 (15" E)
SDCO #20, 8" SDCO RIM=33.36 IE=28.56 (15" W) IE=28.56 (15" E)
SDCO #21, 8" SDCO RIM=33.62 IE=27.18 (15" W) IE=27.18 (15" S)
SDCO #22, 8" SDCO RIM=34.33 IE=26.74 (15" N) IE=26.74 (15" E)
SDCO #23, 8" SDCO RIM=30.65 IE=28.50 (8" E)
SDCO #24, 8" SDCO RIM=30.73 IE=28.30 (12" S)
SDCO #25, 8" SDCO RIM=30.70 IE=27.02 (12" N) IE=27.02 (12" S)
WQ VAULT #2, 6'X12' VAULT RIM=31.50 IE=21.07 (18" S) IE=18.90 (18" N)

MATCHLINE- SEE SHEET C9FOR CONTINUATION

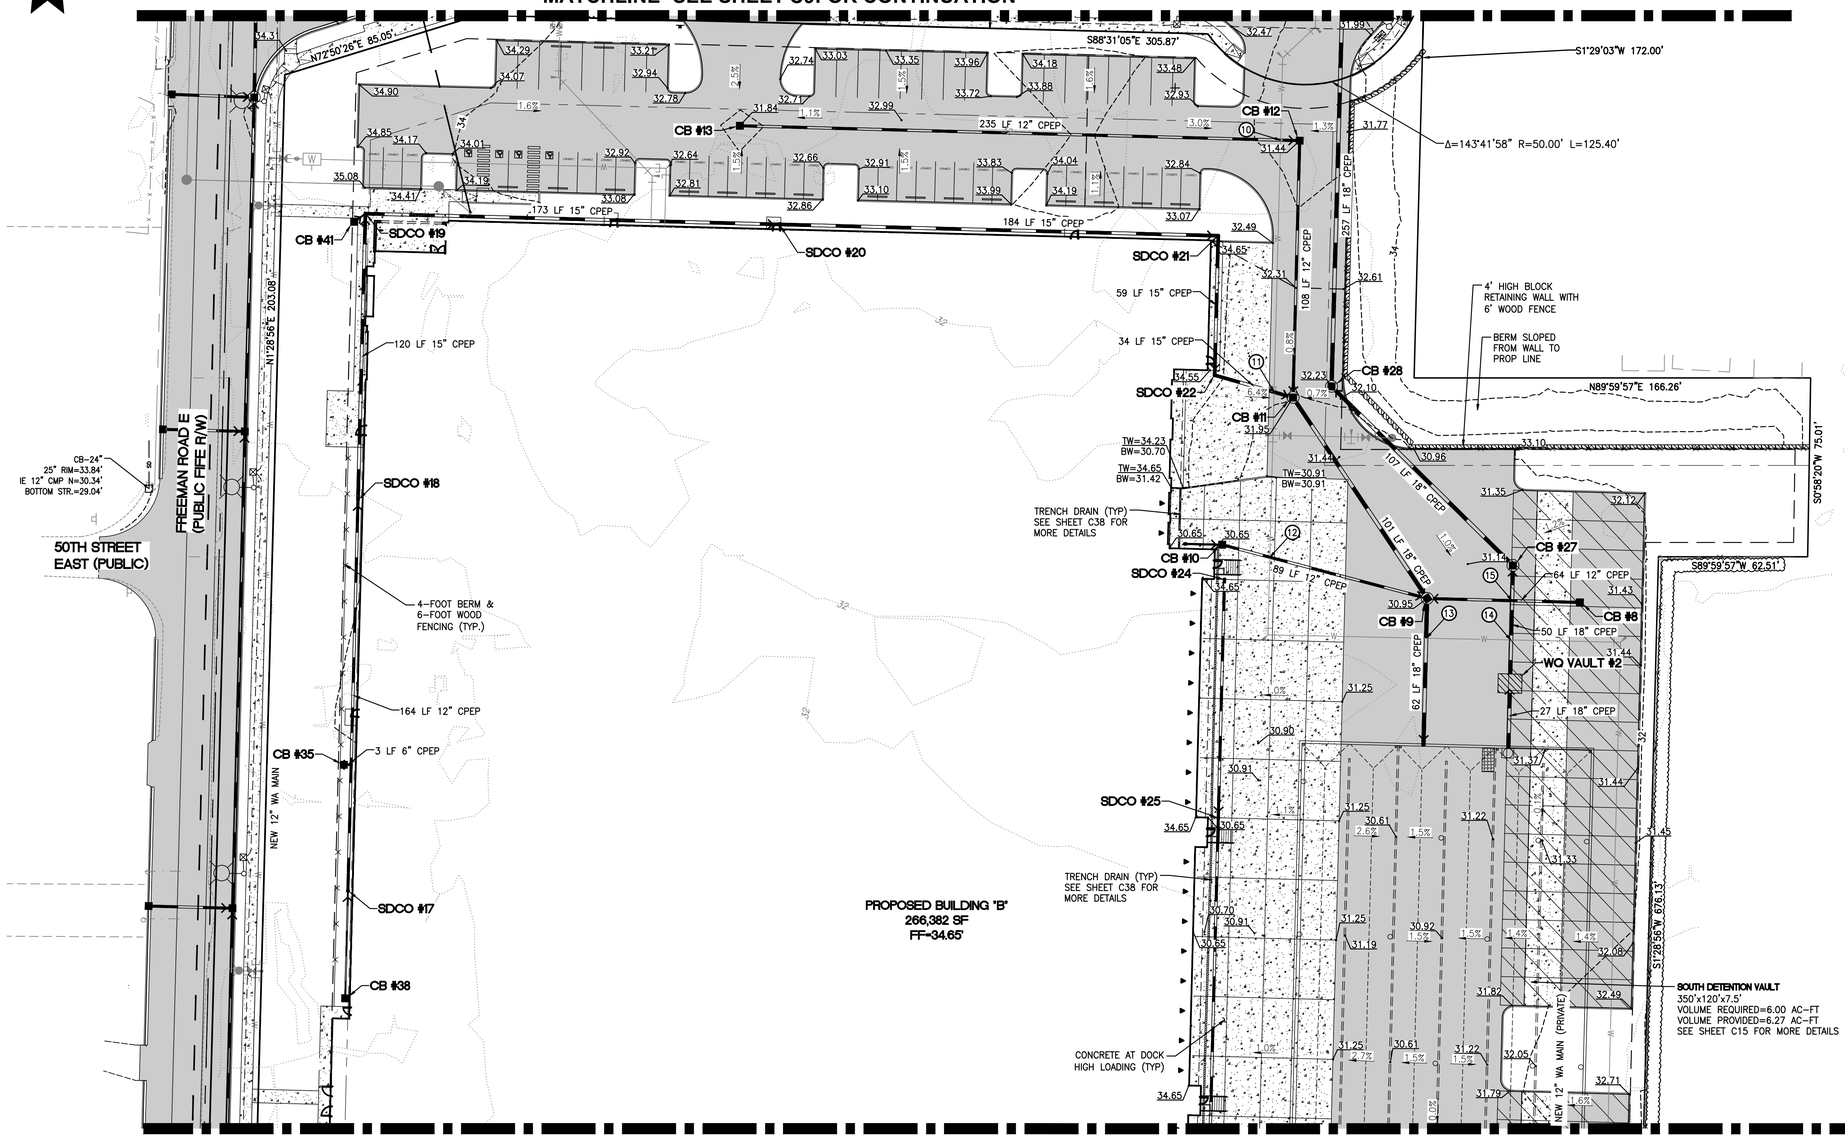

MATCHLINE- SEE SHEET C11 FOR CONTINUATION

UTILITY CROSSING TABLE					
#	BOTTOM UTILITY	TOP	TOP UTILITY	BOTTOM	CLEAR (FT)
10	12" STORM	26.10	12" STORM	27.10	1.00
11	15" STORM	26.75	12" WATER	27.75	1.00
12	18" STORM	26.60	12" STORM	27.60	1.00
13	18" STORM	26.80	12" WATER	27.80	1.00
14	18" STORM	20.20	12" WATER	27.00	6.80
15	18" STORM	20.00	12" STORM	26.50	6.50

UTILITY CROSSING NOTE:
CONTRACTOR SHALL MAINTAIN MINIMUM VERTICAL SEPARATION BETWEEN UTILITIES AS REQUIRED BY JURISDICTIONS HAVING AUTHORITY. CONTRACTOR TO VERIFY SEPARATION REQUIREMENTS PRIOR TO CONSTRUCTION AND NOTIFY ENGINEER OF ANY DISCREPANCIES.

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	06/02/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title:
PRELIMINARY GRADING AND DRAINAGE PLAN
FOR
FREEMAN LOGISTICS

For:
VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDELL
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
6/3/25

Scale: Horizontal 1"=30' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 6/3/25

Barghausen
Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585

Sheet C10 of 48


P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 6/3/2025 12:21 PM DCASEY

PRELIMINARY GRADING AND DRAINAGE PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 15' 30' 60'
SCALE: 1"=30'

MATCHLINE- SEE SHEET C10 FOR CONTINUATION

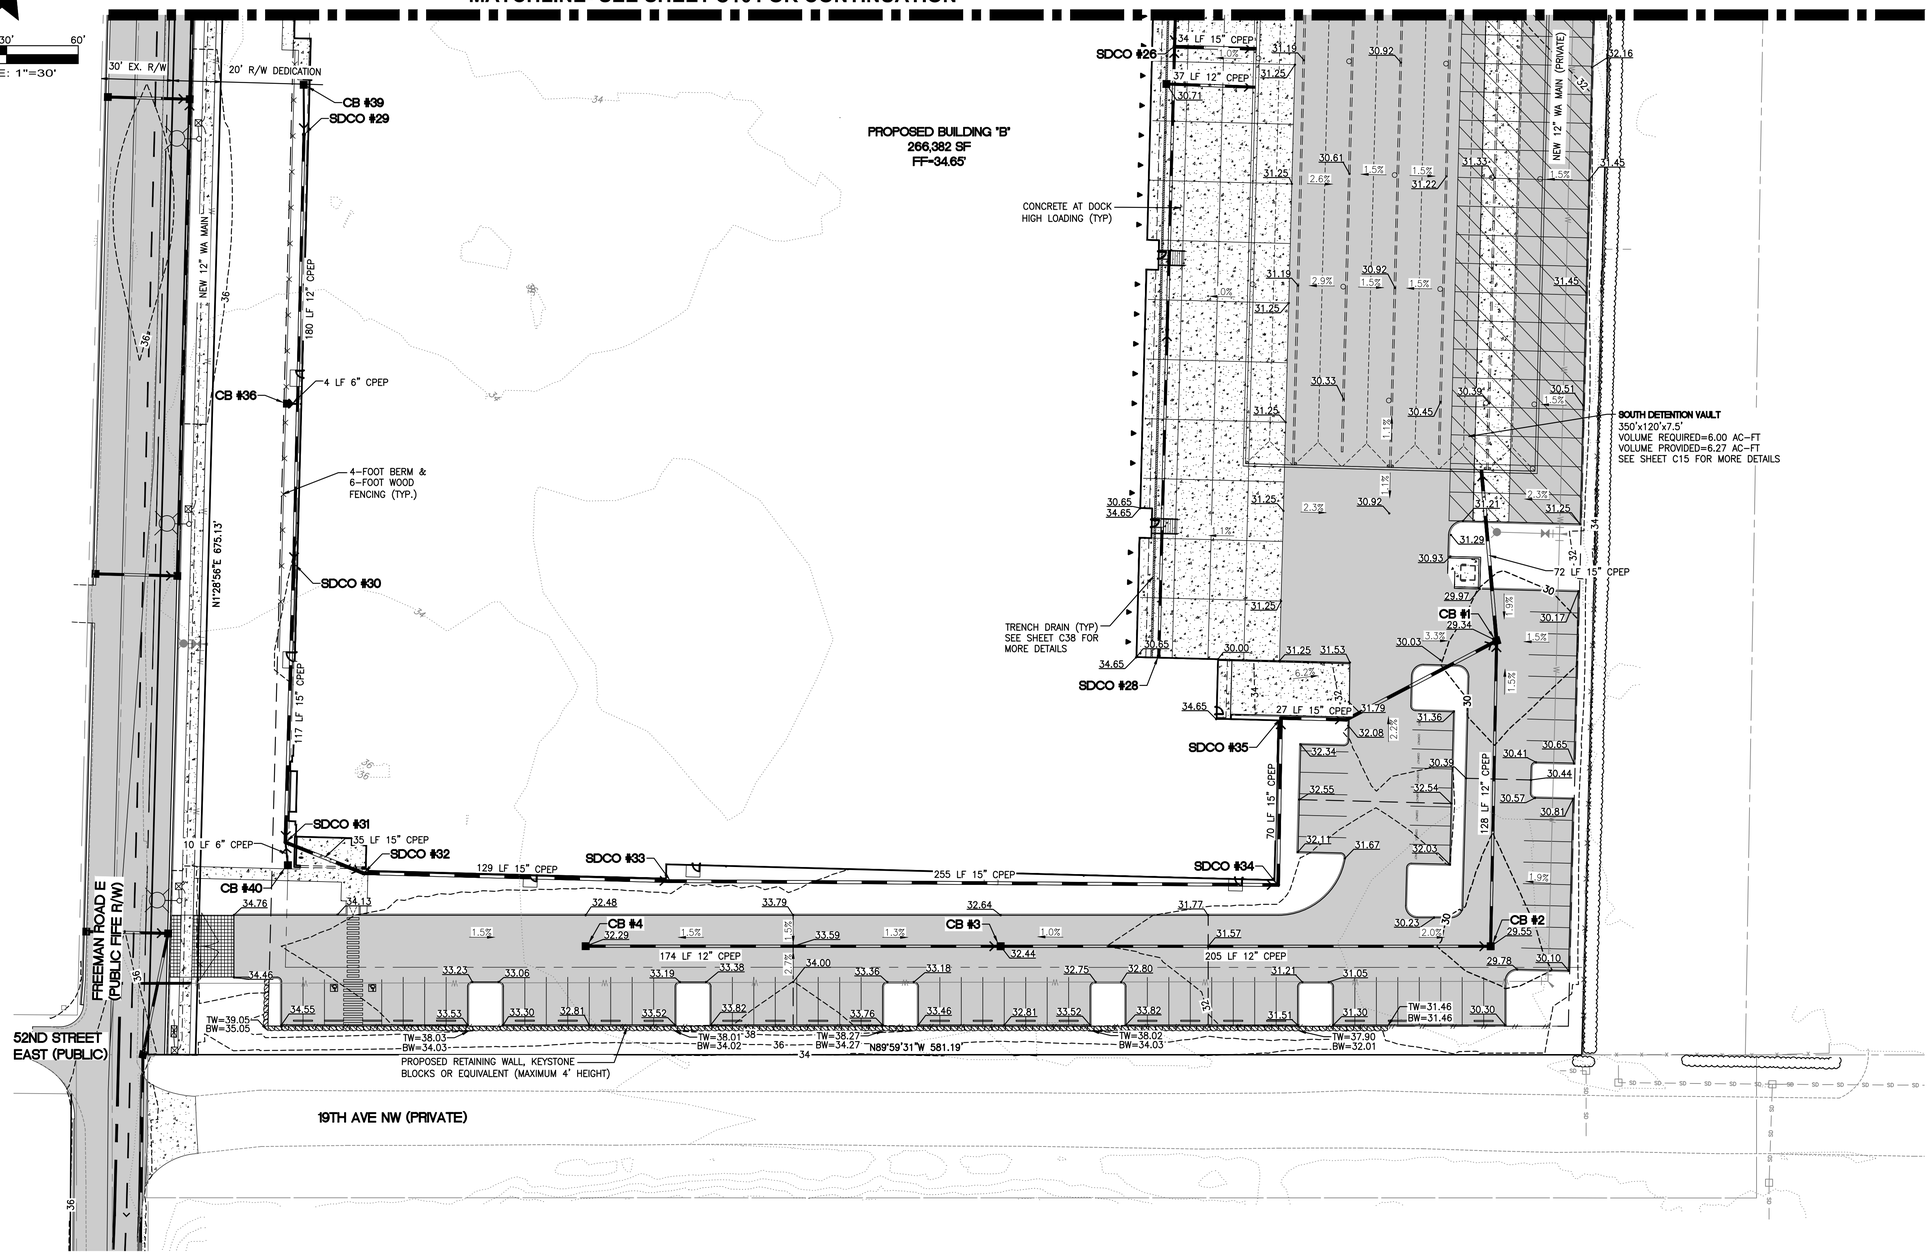

CATCH BASINS
CB #1, TYPE 1L, W/STANDARD GRATE RIM=29.34 IE=26.13 (12" S) IE=25.88 (15" SW) IE=25.88 (15" N)
CB #2, TYPE 1, W/STANDARD GRATE RIM=29.55 IE=27.80 (12" W) IE=27.80 (12" N)
CB #3, TYPE 1, W/STANDARD GRATE RIM=32.44 IE=28.83 (12" W) IE=28.83 (12" E)
CB #4, TYPE 1, W/STANDARD GRATE RIM=32.29 IE=29.70 (12" E)
CB #14, TYPE 1, W/STANDARD GRATE RIM=30.71 IE=27.70 (12" E)
CB #36, TYPE 1, W/STANDARD GRATE RIM=34.80 IE=31.33 (6" E)
CB #39, TYPE 1, W/STANDARD GRATE RIM=34.53 IE=32.63 (6" S)
CB #40, TYPE 1, W/STANDARD GRATE RIM=34.54 IE=31.00 (6" N)
SDCO #26, 8" SDCO RIM=30.74 IE=25.19 (12" S) IE=25.19 (12" N) IE=24.94 (15" E)
SDCO #27, 8" SDCO RIM=30.74 IE=26.63 (12" S) IE=26.63 (12" N)
SDCO #28, 8" SDCO RIM=30.47 IE=28.30 (12" N)
SDCO #29, 8" SDCO RIM=34.61 IE=32.50 (6" N) IE=32.00 (12" S)
SDCO #31, 8" SDCO RIM=34.77 IE=29.73 (15" N) IE=30.48 (6" S) IE=29.73 (15" E)
SDCO #32, 8" SDCO RIM=34.51 IE=29.50 (15" W) IE=29.50 (15" E)
SDCO #33, 8" SDCO RIM=34.44 IE=28.65 (15" W) IE=28.65 (15" E)
SDCO #34, 8" SDCO RIM=32.34 IE=26.98 (15" W) IE=26.98 (15" N)
SDCO #35, 8" SDCO RIM=33.03 IE=26.52 (15" S) IE=26.52 (15" E)
SDCO #36, 8" SDCO RIM=32.33 IE=26.37 (15" W) IE=26.37 (15" NE)

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	06/02/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY GRADING AND DRAINAGE PLAN**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCABEE
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
6/3/25

Scale: Horizontal 1"=30' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 6/3/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C11 of 48

P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 6/3/2025 12:21 PM DCASEY

PRELIMINARY DRAINAGE OUTLET PLAN


OF


FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 25' 50' 100'
SCALE: 1"=50'

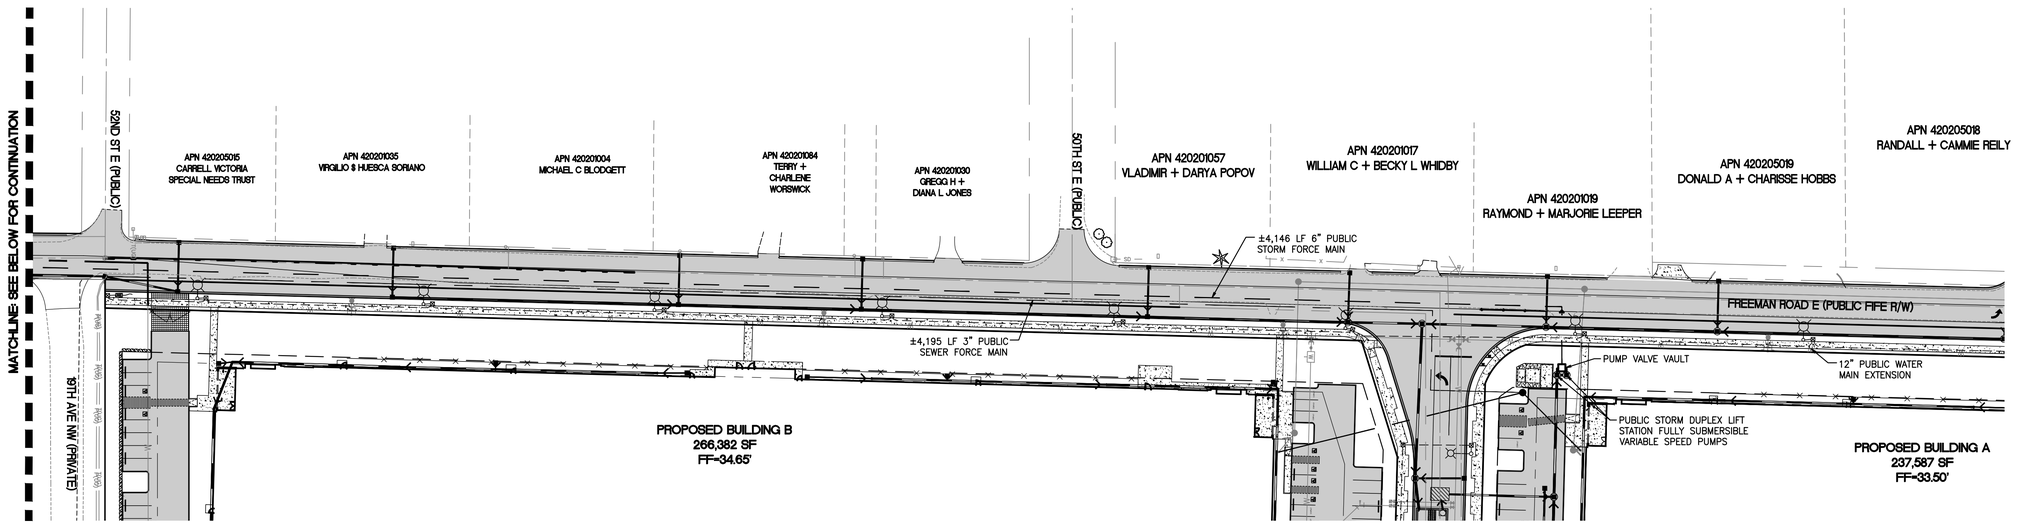

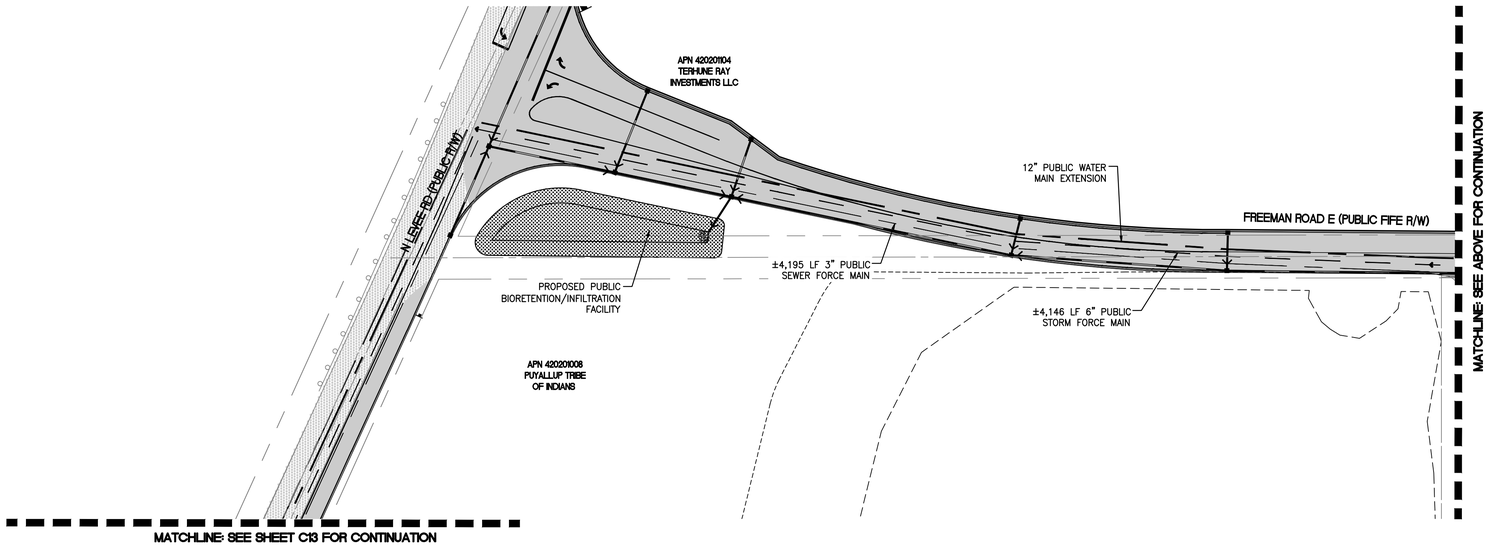

ENGINEER'S REVIEW
FIFE
☐ APPROVED
☐ APPROVED AS CORRECTED
☐ REVISE AND RESUBMIT
☐ REJECTED
☐ FOR INFORMATION ONLY
THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.
BY DATE

APPROVED
BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING
DATE _____
NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	06/02/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY DRAINAGE OUTLET PLAN**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCCASKEL
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
6/3/25

Scale: Horizontal 1"=50' Vertical N/A
Designed JSM. Drawn DTC. Checked JSM. Approved JSM. Date 6/3/25

Barghausen
Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585
Sheet C12 of 48

P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 6/3/2025 12:21 PM DCASEY

PRELIMINARY DRAINAGE OUTLET PLAN


OF


FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 25' 50' 100'
SCALE: 1"=50'

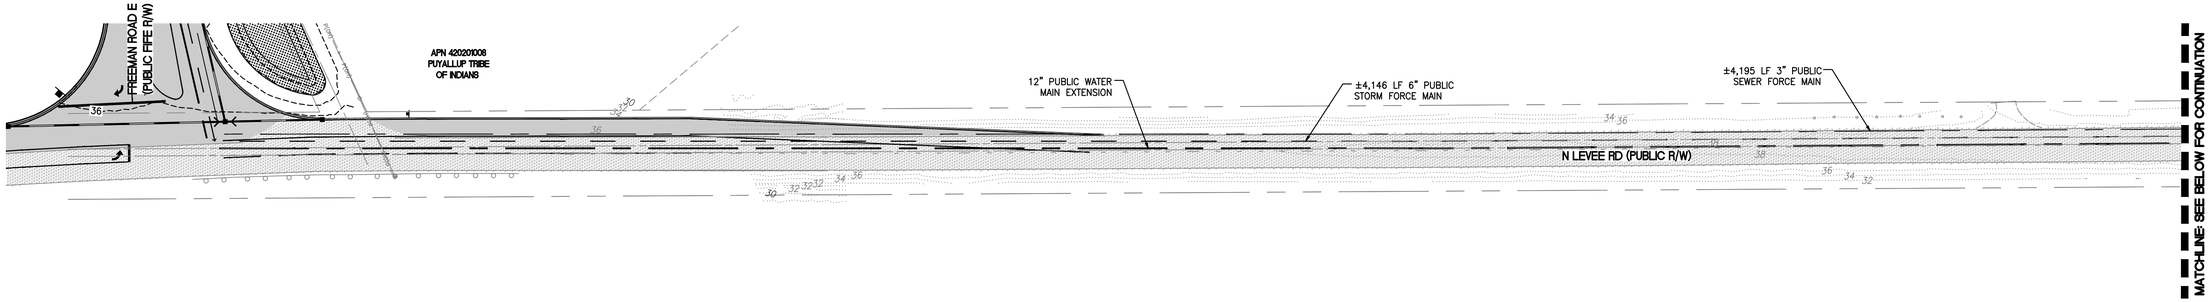

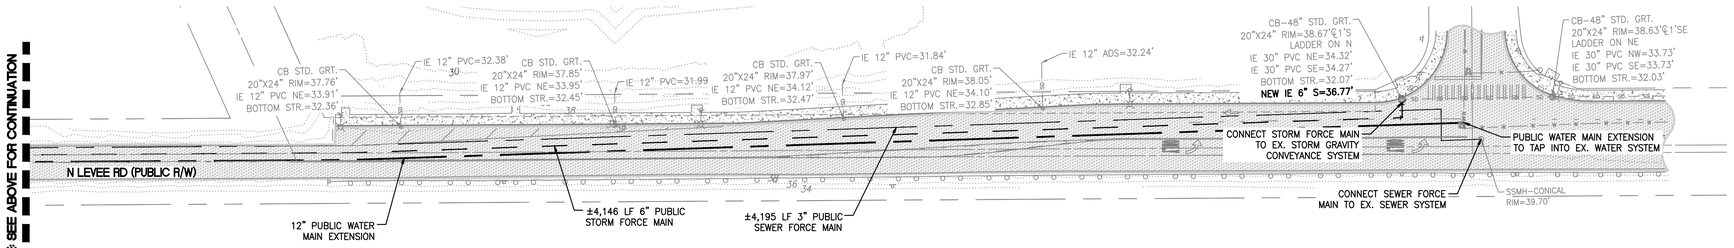

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	06/02/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY DRAINAGE OUTLET PLAN**

FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARDELL
STATE OF WASHINGTON
54927
REGISTERED
PROFESSIONAL ENGINEER
6/3/25

Scale: Horizontal 1"=50' Vertical N/A

Designed JSM. Drawn DTC. Checked JSM. Approved JSM. Date 6/3/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Job Number 21585

Sheet C13 of 48

P:\21000s\21585\engineering\SEPA SET\21585-GM.dwg 6/3/2025 12:21 PM DCASEY

STORMWATER TRIBUTARY BASIN MAPS

DEVELOPED BASIN - NORTH
FOR
FREEMAN ROAD LOGISTICS

A PORTION OF THE SE¼ OF SEC. 17, TWP. 20 NORTH, RGE. 4 EAST AND
A PORTION OF THE NE¼ OF SEC. 20, TWP. 20 NORTH, RGE. 4 EAST, W.M.
CITY OF FIFE, PIERCE COUNTY, WASHINGTON

N

0 25' 50' 100'
SCALE: 1"=50'



FREEMAN ROAD DEVELOPED BASIN - NORTH

NORTH	TRIBUTARY				
	BUILDING	237,615	SF	5.45	AC
	ASPHALT	135,854	SF	3.12	AC
	SIDEWALK	26,299	SF	0.60	AC
	TOTAL PAVEMENT	162,153	SF	3.72	AC
	LANDSCAPE	70,130	SF	1.61	AC
TOTAL		469,898	SF	10.79	AC

811 Know what's below. Call before you dig.

No.	Date	By	Ckd.	Appr.	Revision

Title: **DEVELOPED BASIN - NORTH**
FREEMAN ROAD LOGISTICS

For:
VECTOR DEVELOPMENT COMPANY
11335 NE 122ND WAY, SUITE 105
KIRKLAND, WA 98034

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Designed JSM Drawn DTC Checked JSM Approved JSM Date 7/9/21
Scale: Horizontal 1"=50' Vertical N/A

Job Number 21585
Sheet 2 of 8

P:\21000s\21585\exhibit\21585-basin seps.dwg 5/29/2025 1:54 PM DCASEY

DEVELOPED BASIN - SOUTH
FOR
FREEMAN ROAD LOGISTICS

A PORTION OF THE SE¼ OF SEC. 17, TWP. 20 NORTH, RGE. 4 EAST AND
A PORTION OF THE NE¼ OF SEC. 20, TWP. 20 NORTH, RGE. 4 EAST, W.M.
CITY OF FIFE, PIERCE COUNTY, WASHINGTON

N

0 25' 50' 100'
SCALE: 1"=50'



FREEMAN ROAD DEVELOPED BASIN - SOUTH

SOUTH	TRIBUTARY				
	BUILDING	266,408	SF	6.12	AC
	ASPHALT	126,514	SF	2.90	AC
	SIDEWALK	43,669	SF	1.00	AC
	TOTAL PAVEMENT	170,183	SF	3.91	AC
	LANDSCAPE	79,032	SF	1.81	AC
TOTAL		515,623	SF	11.84	AC

811 Know what's below. Call before you dig.

No.	Date	By	Ckd.	Appr.	Revision

Title: **DEVELOPED BASIN - SOUTH**
FREEMAN ROAD LOGISTICS

For:
VECTOR DEVELOPMENT COMPANY
11335 NE 122ND WAY, SUITE 105
KIRKLAND, WA 98034

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Designed JSM
Drawn DTC
Checked JSM
Approved JSM
Date 7/9/21

Scale:
Horizontal 1"=50'
Vertical N/A

Job Number 21585

Sheet 3 of 8

P:\21000s\21585\exhibit\21585-basin sepa.dwg 5/29/2025 1:54 PM DCASEY

DEVELOPED BASIN - OFFSITE

FOR


FREEMAN ROAD LOGISTICS

A PORTION OF THE SE¼ OF SEC. 17, TWP. 20 NORTH, RGE. 4 EAST AND
A PORTION OF THE NE¼ OF SEC. 20, TWP. 20 NORTH, RGE. 4 EAST, W.M.
CITY OF FIFE, PIERCE COUNTY, WASHINGTON

NEW FRONTAGE NORTH					
	ASPHALT	91,632	SF	2.10	AC
	SIDEWALK	13,329	SF	0.31	AC
	LAWN	11,328	SF	0.26	AC
TOTAL		116,289	SF	2.67	AC

0 30' 60' 120'
SCALE: 1"=60'

811 Know what's below. Call before you dig.

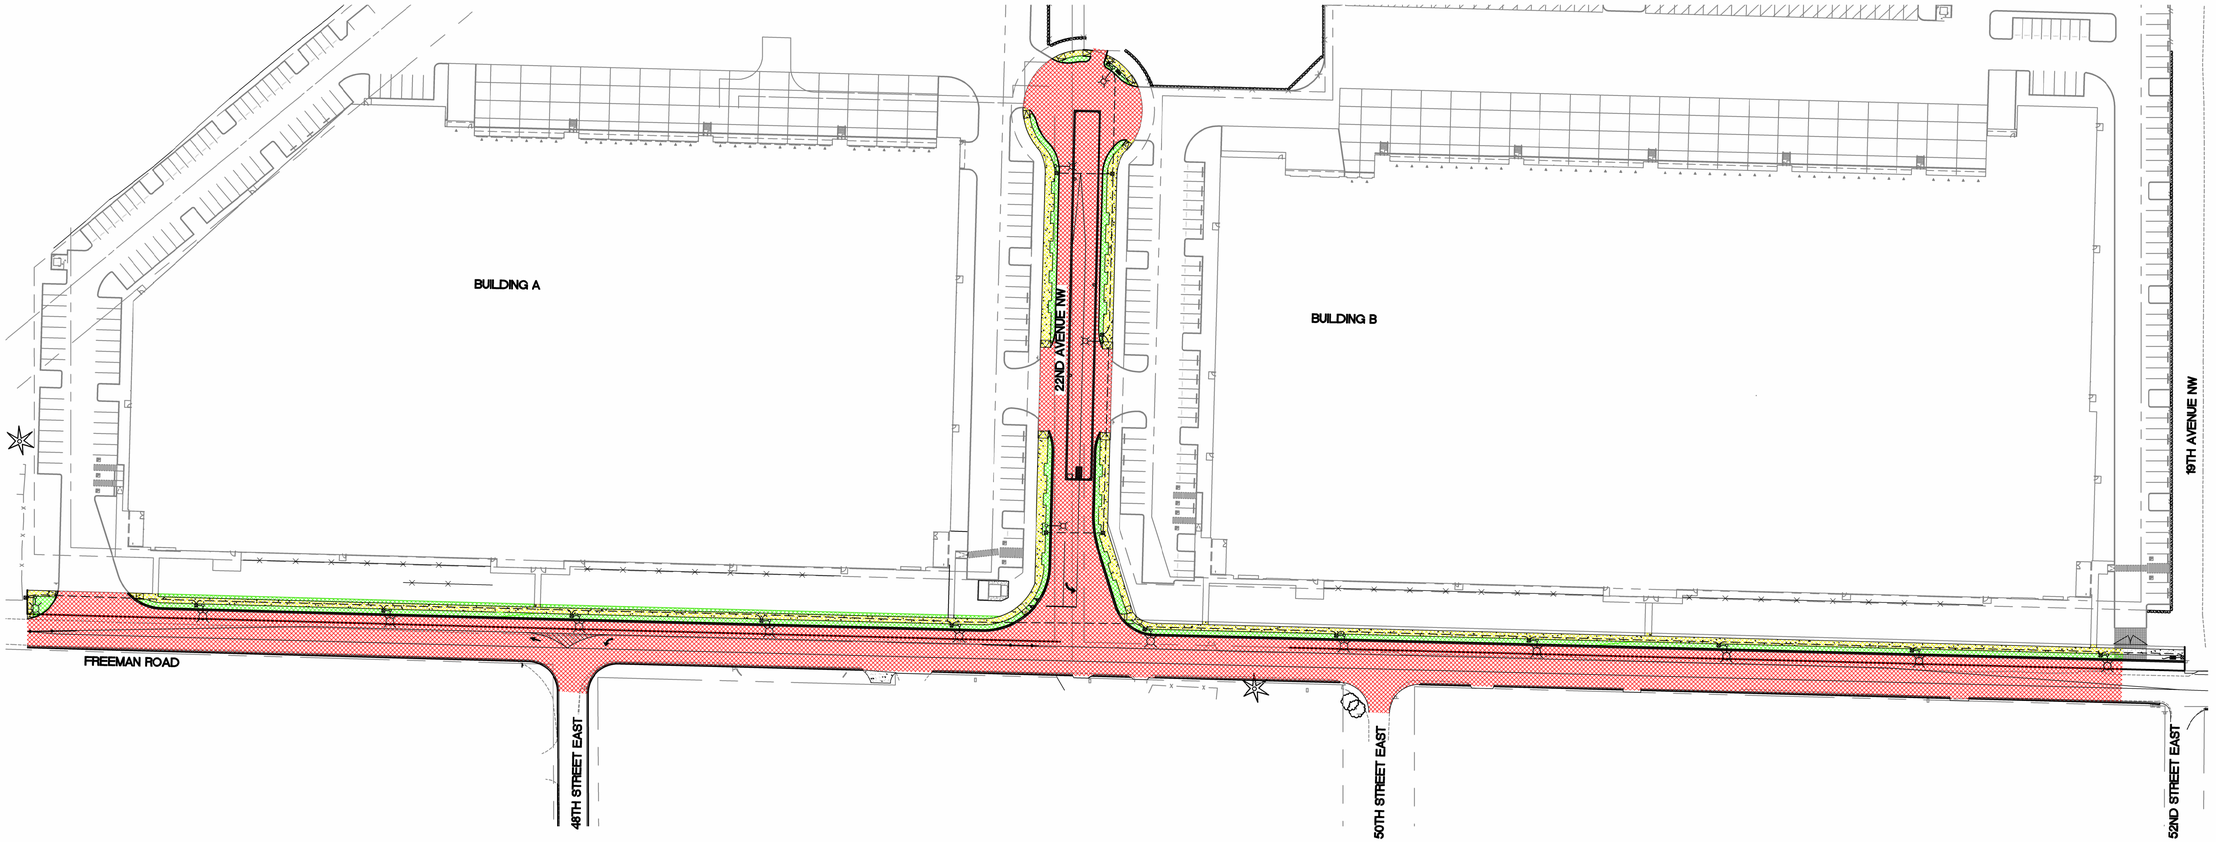

No.	Date	By	Ckd.	Appr.	Revision

Title: **DEVELOPED BASIN - OFFSITE**
FREEMAN ROAD LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11335 NE 122ND WAY, SUITE 105
KIRKLAND, WA 98034

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Designed JSM | Drawn DTC | Checked JSM | Approved JSM | Date 7/8/21
Scale: Horizontal 1"=60' | Vertical N/A

Job Number 21585
Sheet 4 of 8

P:\21000s\21585\exhibit\21585-basin sepa.dwg 6/3/2025 10:35 AM DCASEY

DEVELOPED BASIN - OFFSITE
FOR
FREEMAN ROAD LOGISTICS

A PORTION OF THE SE¼ OF SEC. 17, TWP. 20 NORTH, RGE. 4 EAST AND
A PORTION OF THE NE¼ OF SEC. 20, TWP. 20 NORTH, RGE. 4 EAST, W.M.
CITY OF FIFE, PIERCE COUNTY, WASHINGTON

N

0 20' 40' 80'
SCALE: 1"=40'

811 Know what's below. Call before you dig.

19TH AVENUE NW

FREEMAN ROAD

N LEVEE ROAD EAST

FREEMAN ROAD DEVELOPED BASIN - OFFSITE

DEVELOPED AREA					
	ASPHALT	43,441	SF	1.00	AC
	LAWN	209	SF	0.01	AC
	SIDEWALK	261	SF	0.01	AC

No.	Date	By	Ckd.	Appr.	Revision

Title: **DEVELOPED BASIN - OFFSITE**
FREEMAN ROAD LOGISTICS

For:
VECTOR DEVELOPMENT COMPANY
11335 NE 122ND WAY, SUITE 105
KIRKLAND, WA 98034

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Designed JSM
Drawn DTC
Checked JSM
Approved JSM
Date 7/8/21

Scale:
Horizontal 1"=40'
Vertical N/A

Job Number 21585
Sheet 5 of 8

P:\21000s\21585\exhibit\21585-basin sepa.dwg 5/29/2025 1:54 PM DCASEY

FLOW CONTROL AND WATER QUALITY CALCULATIONS

WWHM2012

PROJECT REPORT

FLOW CONTROL AND WATER
QUALITY CALCULATIONS
NORTHERN ONSITE BASIN
FREEMAN LOGISTICS
BCE JOB #21585

General Model Information

WWHM2012 Project Name: 21585-CALC-DRNG-NORTH-DETN-2024-08-13

Site Name:	FREEMAN ROAD LOGISTICS
Site Address:	
City:	PUYALLUP
Report Date:	9/24/2024
Gage:	42 IN EAST
Data Start:	10/01/1901
Data End:	09/30/2059
Timestep:	15 Minute
Precip Scale:	1.000
Version Date:	2024/06/28
Version:	4.3.1

POC Thresholds

Low Flow Threshold for POC1:	50 Percent of the 2 Year
High Flow Threshold for POC1:	50 Year

Landuse Basin Data

Predeveloped Land Use

Basin 1

Bypass:	No
GroundWater:	No
Pervious Land Use	acre
C, Forest, Flat	10.78
Pervious Total	10.78
Impervious Land Use	acre
Impervious Total	0
Basin Total	10.78

Element Flow Componants:

Surface	Interflow	Groundwater
Componant Flows To:		
POC 1	POC 1	

Mitigated Land Use

Basin 1

Bypass:	No
GroundWater:	No

Pervious Land Use	acre
C, Lawn, Flat	1.61
Pervious Total	1.61

Impervious Land Use	acre
ROOF TOPS FLAT	5.45
SIDEWALKS FLAT	0.6
PARKING FLAT	3.12
Impervious Total	9.17
Basin Total	10.78

Element Flow Componants:

Surface	Interflow	Groundwater

Componant Flows To:

Vault 1	Vault 1

Mitigated Routing

Vault 1

Width: 100 ft.
Length: 355 ft.
Depth: 7.5 ft.
Discharge Structure
Riser Height: 6.5 ft.
Riser Diameter: 18 in.
Orifice 1 Diameter: 1.540 in. Elevation:0 ft.
Orifice 2 Diameter: 2.310 in. Elevation:4.43 ft.
Orifice 3 Diameter: 1.990 in. Elevation:5.17 ft.
Element Outlets:
Outlet 1 Outlet 2
Outlet Flows To:


Vault Hydraulic Table


Stage(feet)	Area(ac.)	Volume(ac-ft.)	Discharge(cfs)	Infilt(cfs)
0.0000	0.815	0.000	0.000	0.000
0.0833	0.815	0.067	0.018	0.000
0.1667	0.815	0.135	0.026	0.000
0.2500	0.815	0.203	0.032	0.000
0.3333	0.815	0.271	0.037	0.000
0.4167	0.815	0.339	0.041	0.000
0.5000	0.815	0.407	0.045	0.000
0.5833	0.815	0.475	0.049	0.000
0.6667	0.815	0.543	0.052	0.000
0.7500	0.815	0.611	0.055	0.000
0.8333	0.815	0.679	0.058	0.000
0.9167	0.815	0.747	0.061	0.000
1.0000	0.815	0.815	0.064	0.000
1.0833	0.815	0.882	0.067	0.000
1.1667	0.815	0.950	0.069	0.000
1.2500	0.815	1.018	0.072	0.000
1.3333	0.815	1.086	0.074	0.000
1.4167	0.815	1.154	0.076	0.000
1.5000	0.815	1.222	0.078	0.000
1.5833	0.815	1.290	0.081	0.000
1.6667	0.815	1.358	0.083	0.000
1.7500	0.815	1.426	0.085	0.000
1.8333	0.815	1.494	0.087	0.000
1.9167	0.815	1.562	0.089	0.000
2.0000	0.815	1.629	0.091	0.000
2.0833	0.815	1.697	0.092	0.000
2.1667	0.815	1.765	0.094	0.000
2.2500	0.815	1.833	0.096	0.000
2.3333	0.815	1.901	0.098	0.000
2.4167	0.815	1.969	0.100	0.000
2.5000	0.815	2.037	0.101	0.000
2.5833	0.815	2.105	0.103	0.000
2.6667	0.815	2.173	0.105	0.000
2.7500	0.815	2.241	0.106	0.000
2.8333	0.815	2.309	0.108	0.000
2.9167	0.815	2.377	0.109	0.000
3.0000	0.815	2.444	0.111	0.000

3.0833	0.815	2.512	0.113	0.000
3.1667	0.815	2.580	0.114	0.000
3.2500	0.815	2.648	0.116	0.000
3.3333	0.815	2.716	0.117	0.000
3.4167	0.815	2.784	0.119	0.000
3.5000	0.815	2.852	0.120	0.000
3.5833	0.815	2.920	0.121	0.000
3.6667	0.815	2.988	0.123	0.000
3.7500	0.815	3.056	0.124	0.000
3.8333	0.815	3.124	0.126	0.000
3.9167	0.815	3.192	0.127	0.000
4.0000	0.815	3.259	0.128	0.000
4.0833	0.815	3.327	0.130	0.000
4.1667	0.815	3.395	0.131	0.000
4.2500	0.815	3.463	0.132	0.000
4.3333	0.815	3.531	0.134	0.000
4.4167	0.815	3.599	0.135	0.000
4.5000	0.815	3.667	0.174	0.000
4.5833	0.815	3.735	0.194	0.000
4.6667	0.815	3.803	0.209	0.000
4.7500	0.815	3.871	0.222	0.000
4.8333	0.815	3.939	0.233	0.000
4.9167	0.815	4.006	0.243	0.000
5.0000	0.815	4.074	0.253	0.000
5.0833	0.815	4.142	0.262	0.000
5.1667	0.815	4.210	0.270	0.000
5.2500	0.815	4.278	0.309	0.000
5.3333	0.815	4.346	0.329	0.000
5.4167	0.815	4.414	0.347	0.000
5.5000	0.815	4.482	0.362	0.000
5.5833	0.815	4.550	0.376	0.000
5.6667	0.815	4.618	0.390	0.000
5.7500	0.815	4.686	0.402	0.000
5.8333	0.815	4.754	0.414	0.000
5.9167	0.815	4.821	0.426	0.000
6.0000	0.815	4.889	0.437	0.000
6.0833	0.815	4.957	0.447	0.000
6.1667	0.815	5.025	0.457	0.000
6.2500	0.815	5.093	0.467	0.000
6.3333	0.815	5.161	0.477	0.000
6.4167	0.815	5.229	0.487	0.000
6.5000	0.815	5.297	0.496	0.000
6.5833	0.815	5.365	0.887	0.000
6.6667	0.815	5.433	1.588	0.000
6.7500	0.815	5.501	2.461	0.000
6.8333	0.815	5.568	3.413	0.000
6.9167	0.815	5.636	4.352	0.000
7.0000	0.815	5.704	5.186	0.000
7.0833	0.815	5.772	5.849	0.000
7.1667	0.815	5.840	6.318	0.000
7.2500	0.815	5.908	6.643	0.000
7.3333	0.815	5.976	7.048	0.000
7.4167	0.815	6.044	7.371	0.000
7.5000	0.815	6.112	7.680	0.000
7.5833	0.815	6.180	7.977	0.000
7.6667	0.000	0.000	8.263	0.000

Analysis Results

POC 1

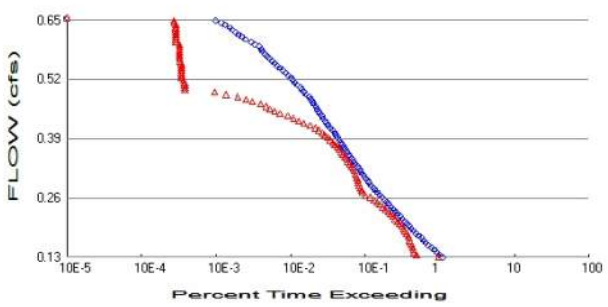

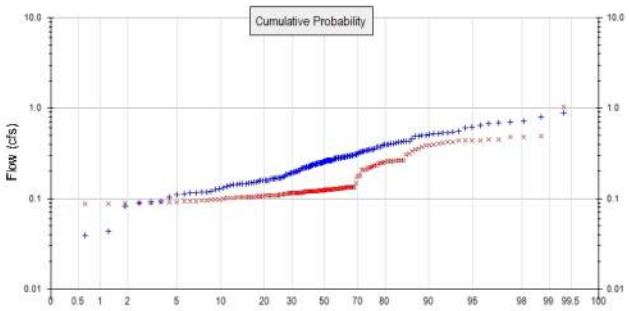

\+ Predeveloped x Mitigated

Predeveloped Landuse Totals for POC #1
Total Pervious Area: 10.78
Total Impervious Area: 0

Mitigated Landuse Totals for POC #1
Total Pervious Area: 1.61
Total Impervious Area: 9.17

Flow Frequency Method: Log Pearson Type III 17B

Flow Frequency Return Periods for Predeveloped. POC #1

Return Period	**Flow(cfs)**
2 year	0.259602
5 year	0.398289
10 year	0.48347
25 year	0.581891
50 year	0.648562
100 year	0.709894

Flow Frequency Return Periods for Mitigated. POC #1

Return Period	**Flow(cfs)**
2 year	0.142619
5 year	0.227599
10 year	0.304305
25 year	0.430264
50 year	0.549413
100 year	0.694305

WATER QUALITY DESIGN FLOW RATE
EQUAL TO 2 YEAR RELEASE RATE
DOWNSTREAM OF DETENTION

Annual Peaks

Annual Peaks for Predeveloped and Mitigated. POC #1

Year	**Predeveloped**	**Mitigated**
1902	0.249	0.126
1903	0.159	0.098
1904	0.293	0.116
1905	0.139	0.179
1906	0.082	0.087
1907	0.405	0.122
1908	0.286	0.104
1909	0.278	0.124
1910	0.395	0.124
1911	0.257	0.119

1912	0.894	0.134
1913	0.400	0.261
1914	0.104	0.089
1915	0.178	0.222
1916	0.259	0.114
1917	0.091	0.108
1918	0.267	0.350
1919	0.225	0.116
1920	0.263	0.119
1921	0.288	0.172
1922	0.281	0.121
1923	0.230	0.217
1924	0.114	0.109
1925	0.151	0.106
1926	0.248	0.115
1927	0.205	0.120
1928	0.196	0.128
1929	0.392	0.211
1930	0.253	0.120
1931	0.247	0.125
1932	0.184	0.148
1933	0.217	0.126
1934	0.517	0.445
1935	0.243	0.309
1936	0.234	0.129
1937	0.351	0.116
1938	0.222	0.121
1939	0.024	0.089
1940	0.243	0.180
1941	0.158	0.092
1942	0.368	0.447
1943	0.174	0.125
1944	0.393	0.263
1945	0.293	0.123
1946	0.165	0.102
1947	0.131	0.109
1948	0.545	0.126
1949	0.485	0.315
1950	0.155	0.111
1951	0.199	0.108
1952	0.697	0.337
1953	0.645	0.441
1954	0.236	0.133
1955	0.206	0.100
1956	0.117	0.101
1957	0.342	0.230
1958	0.680	0.484
1959	0.423	0.454
1960	0.119	0.093
1961	0.430	0.440
1962	0.243	0.130
1963	0.114	0.090
1964	0.136	0.103
1965	0.486	0.402
1966	0.149	0.115
1967	0.218	0.103
1968	0.239	0.135
1969	0.221	0.122

1970	0.339	0.128
1971	0.507	0.388
1972	0.333	0.129
1973	0.435	0.258
1974	0.235	0.119
1975	0.528	0.478
1976	0.291	0.126
1977	0.146	0.089
1978	0.464	0.396
1979	0.143	0.111
1980	0.280	0.120
1981	0.267	0.130
1982	0.145	0.092
1983	0.428	0.218
1984	0.200	0.113
1985	0.320	0.116
1986	0.264	0.134
1987	0.496	0.370
1988	0.309	0.245
1989	0.284	0.114
1990	0.334	0.121
1991	0.264	0.128
1992	0.326	0.352
1993	0.346	0.120
1994	0.505	0.129
1995	0.124	0.118
1996	0.552	0.426
1997	0.248	0.105
1998	0.281	0.121
1999	0.039	0.104
2000	0.213	0.135
2001	0.111	0.087
2002	0.374	0.121
2003	0.325	0.129
2004	0.277	0.124
2005	0.535	0.131
2006	0.169	0.114
2007	0.186	0.123
2008	0.282	0.120
2009	0.192	0.115
2010	0.165	0.233
2011	0.151	0.109
2012	0.257	0.115
2013	0.165	0.092
2014	0.118	0.094
2015	0.228	0.109
2016	0.093	0.109
2017	0.373	0.265
2018	0.685	0.494
2019	0.723	0.436
2020	0.217	0.106
2021	0.354	0.266
2022	0.150	0.104
2023	0.298	0.131
2024	0.801	0.119
2025	0.265	0.126
2026	0.425	0.257
2027	0.168	0.110

2028	0.143	0.093
2029	0.283	0.251
2030	0.521	0.228
2031	0.168	0.098
2032	0.116	0.096
2033	0.158	0.100
2034	0.159	0.109
2035	0.609	1.026
2036	0.313	0.135
2037	0.090	0.103
2038	0.263	0.246
2039	0.043	0.082
2040	0.159	0.112
2041	0.188	0.104
2042	0.615	0.426
2043	0.297	0.261
2044	0.387	0.248
2045	0.256	0.210
2046	0.300	0.386
2047	0.224	0.135
2048	0.297	0.120
2049	0.267	0.124
2050	0.193	0.117
2051	0.308	0.126
2052	0.168	0.122
2053	0.287	0.410
2054	0.348	0.266
2055	0.144	0.097
2056	0.129	0.105
2057	0.198	0.129
2058	0.246	0.208
2059	0.411	0.203

Ranked Annual Peaks

Ranked Annual Peaks for Predeveloped and Mitigated. POC #1

Rank	Predeveloped	Mitigated
1	0.8944	1.0261
2	0.8013	0.4944
3	0.7232	0.4843
4	0.6971	0.4783
5	0.6846	0.4539
6	0.6798	0.4475
7	0.6446	0.4447
8	0.6147	0.4413
9	0.6093	0.4400
10	0.5521	0.4362
11	0.5453	0.4256
12	0.5349	0.4255
13	0.5284	0.4095
14	0.5207	0.4021
15	0.5169	0.3957
16	0.5075	0.3878
17	0.5054	0.3860
18	0.4957	0.3702
19	0.4860	0.3523
20	0.4854	0.3502
21	0.4642	0.3368
22	0.4350	0.3153

23	0.4302	0.3093
24	0.4283	0.2662
25	0.4248	0.2660
26	0.4232	0.2648
27	0.4106	0.2632
28	0.4054	0.2611
29	0.4003	0.2608
30	0.3948	0.2581
31	0.3927	0.2569
32	0.3925	0.2512
33	0.3872	0.2479
34	0.3743	0.2458
35	0.3729	0.2450
36	0.3684	0.2332
37	0.3541	0.2304
38	0.3508	0.2280
39	0.3484	0.2220
40	0.3463	0.2178
41	0.3421	0.2170
42	0.3392	0.2108
43	0.3345	0.2104
44	0.3333	0.2079
45	0.3261	0.2028
46	0.3251	0.1797
47	0.3203	0.1786
48	0.3129	0.1722
49	0.3086	0.1481
50	0.3082	0.1348
51	0.3000	0.1348
52	0.2977	0.1347
53	0.2973	0.1345
54	0.2971	0.1342
55	0.2928	0.1336
56	0.2926	0.1334
57	0.2906	0.1312
58	0.2884	0.1311
59	0.2868	0.1303
60	0.2857	0.1301
61	0.2836	0.1295
62	0.2832	0.1293
63	0.2817	0.1291
64	0.2810	0.1290
65	0.2808	0.1285
66	0.2797	0.1284
67	0.2778	0.1281
68	0.2774	0.1279
69	0.2672	0.1262
70	0.2667	0.1262
71	0.2666	0.1260
72	0.2654	0.1259
73	0.2640	0.1257
74	0.2636	0.1256
75	0.2632	0.1253
76	0.2630	0.1248
77	0.2591	0.1245
78	0.2571	0.1241
79	0.2568	0.1239
80	0.2556	0.1236

81	0.2525	0.1232
82	0.2490	0.1229
83	0.2485	0.1219
84	0.2477	0.1218
85	0.2470	0.1215
86	0.2462	0.1215
87	0.2428	0.1214
88	0.2427	0.1210
89	0.2426	0.1209
90	0.2387	0.1206
91	0.2360	0.1205
92	0.2348	0.1203
93	0.2344	0.1203
94	0.2299	0.1202
95	0.2278	0.1199
96	0.2250	0.1196
97	0.2244	0.1193
98	0.2218	0.1190
99	0.2214	0.1190
100	0.2184	0.1187
101	0.2175	0.1177
102	0.2168	0.1175
103	0.2132	0.1161
104	0.2055	0.1158
105	0.2050	0.1157
106	0.2003	0.1155
107	0.1992	0.1150
108	0.1977	0.1150
109	0.1955	0.1147
110	0.1933	0.1146
111	0.1919	0.1145
112	0.1880	0.1145
113	0.1855	0.1138
114	0.1845	0.1133
115	0.1777	0.1125
116	0.1738	0.1112
117	0.1686	0.1109
118	0.1682	0.1098
119	0.1680	0.1090
120	0.1676	0.1090
121	0.1650	0.1089
122	0.1646	0.1088
123	0.1645	0.1086
124	0.1594	0.1086
125	0.1592	0.1083
126	0.1586	0.1077
127	0.1578	0.1063
128	0.1576	0.1057
129	0.1554	0.1054
130	0.1515	0.1053
131	0.1506	0.1044
132	0.1499	0.1044
133	0.1487	0.1038
134	0.1461	0.1036
135	0.1451	0.1032
136	0.1445	0.1031
137	0.1431	0.1030
138	0.1428	0.1023

139	0.1387	0.1014
140	0.1359	0.1005
141	0.1309	0.1002
142	0.1289	0.0978
143	0.1242	0.0975
144	0.1189	0.0973
145	0.1181	0.0956
146	0.1166	0.0944
147	0.1160	0.0934
148	0.1139	0.0925
149	0.1138	0.0922
150	0.1105	0.0919
151	0.1037	0.0915
152	0.0932	0.0903
153	0.0909	0.0894
154	0.0895	0.0889
155	0.0822	0.0889
156	0.0434	0.0875
157	0.0388	0.0871
158	0.0245	0.0823

Duration Flows

The Facility PASSED


Flow(cfs)	Predev	Mit	Percentage	Pass/Fail
0.1298	60941	52797	86	Pass
0.1350	55063	26686	48	Pass
0.1403	50592	25063	49	Pass
0.1455	46531	24421	52	Pass
0.1508	42841	23772	55	Pass
0.1560	38958	23085	59	Pass
0.1612	36121	22515	62	Pass
0.1665	33517	21922	65	Pass
0.1717	31019	21401	68	Pass
0.1770	28742	20775	72	Pass
0.1822	26398	19667	74	Pass
0.1874	24626	18842	76	Pass
0.1927	22980	18050	78	Pass
0.1979	21490	17052	79	Pass
0.2032	19867	15811	79	Pass
0.2084	18631	14919	80	Pass
0.2136	17374	13922	80	Pass
0.2189	16183	12986	80	Pass
0.2241	14936	11950	80	Pass
0.2294	13972	11119	79	Pass
0.2346	13080	10321	78	Pass
0.2398	12255	9540	77	Pass
0.2451	11324	8615	76	Pass
0.2503	10626	7911	74	Pass
0.2556	9933	7230	72	Pass
0.2608	9280	6482	69	Pass
0.2660	8537	5546	64	Pass
0.2713	7994	4996	62	Pass
0.2765	7468	4858	65	Pass
0.2818	7019	4748	67	Pass
0.2870	6554	4607	70	Pass
0.2922	6221	4476	71	Pass
0.2975	5917	4376	73	Pass
0.3027	5623	4292	76	Pass
0.3080	5319	4206	79	Pass
0.3132	5022	4049	80	Pass
0.3184	4782	3918	81	Pass
0.3237	4553	3778	82	Pass
0.3289	4327	3631	83	Pass
0.3342	4078	3408	83	Pass
0.3394	3874	3230	83	Pass
0.3446	3678	3075	83	Pass
0.3499	3469	2935	84	Pass
0.3551	3286	2758	83	Pass
0.3604	3137	2618	83	Pass
0.3656	2992	2478	82	Pass
0.3708	2845	2328	81	Pass
0.3761	2684	2153	80	Pass
0.3813	2581	2024	78	Pass
0.3866	2461	1872	76	Pass
0.3918	2371	1726	72	Pass
0.3970	2239	1582	70	Pass
0.4023	2143	1473	68	Pass

0.4075	2004	1315	65	Pass
0.4128	1886	1180	62	Pass
0.4180	1757	1005	57	Pass
0.4232	1674	832	49	Pass
0.4285	1590	707	44	Pass
0.4337	1514	606	40	Pass
0.4390	1440	503	34	Pass
0.4442	1356	396	29	Pass
0.4494	1301	336	25	Pass
0.4547	1240	292	23	Pass
0.4599	1194	260	21	Pass
0.4652	1120	218	19	Pass
0.4704	1077	170	15	Pass
0.4756	1029	139	13	Pass
0.4809	980	108	11	Pass
0.4861	896	76	8	Pass
0.4914	839	53	6	Pass
0.4966	786	21	2	Pass
0.5018	744	21	2	Pass
0.5071	678	21	3	Pass
0.5123	632	21	3	Pass
0.5176	590	20	3	Pass
0.5228	559	19	3	Pass
0.5280	510	19	3	Pass
0.5333	475	19	4	Pass
0.5385	436	19	4	Pass
0.5438	396	19	4	Pass
0.5490	367	19	5	Pass
0.5542	341	19	5	Pass
0.5595	310	18	5	Pass
0.5647	286	18	6	Pass
0.5700	267	18	6	Pass
0.5752	247	18	7	Pass
0.5804	234	18	7	Pass
0.5857	222	18	8	Pass
0.5909	208	18	8	Pass
0.5962	183	18	9	Pass
0.6014	163	16	9	Pass
0.6066	139	16	11	Pass
0.6119	122	16	13	Pass
0.6171	110	16	14	Pass
0.6224	102	16	15	Pass
0.6276	92	16	17	Pass
0.6328	85	16	18	Pass
0.6381	73	16	21	Pass
0.6433	64	15	23	Pass
0.6486	55	15	27	Pass

Appendix
Predeveloped Schematic



Mitigated Schematic

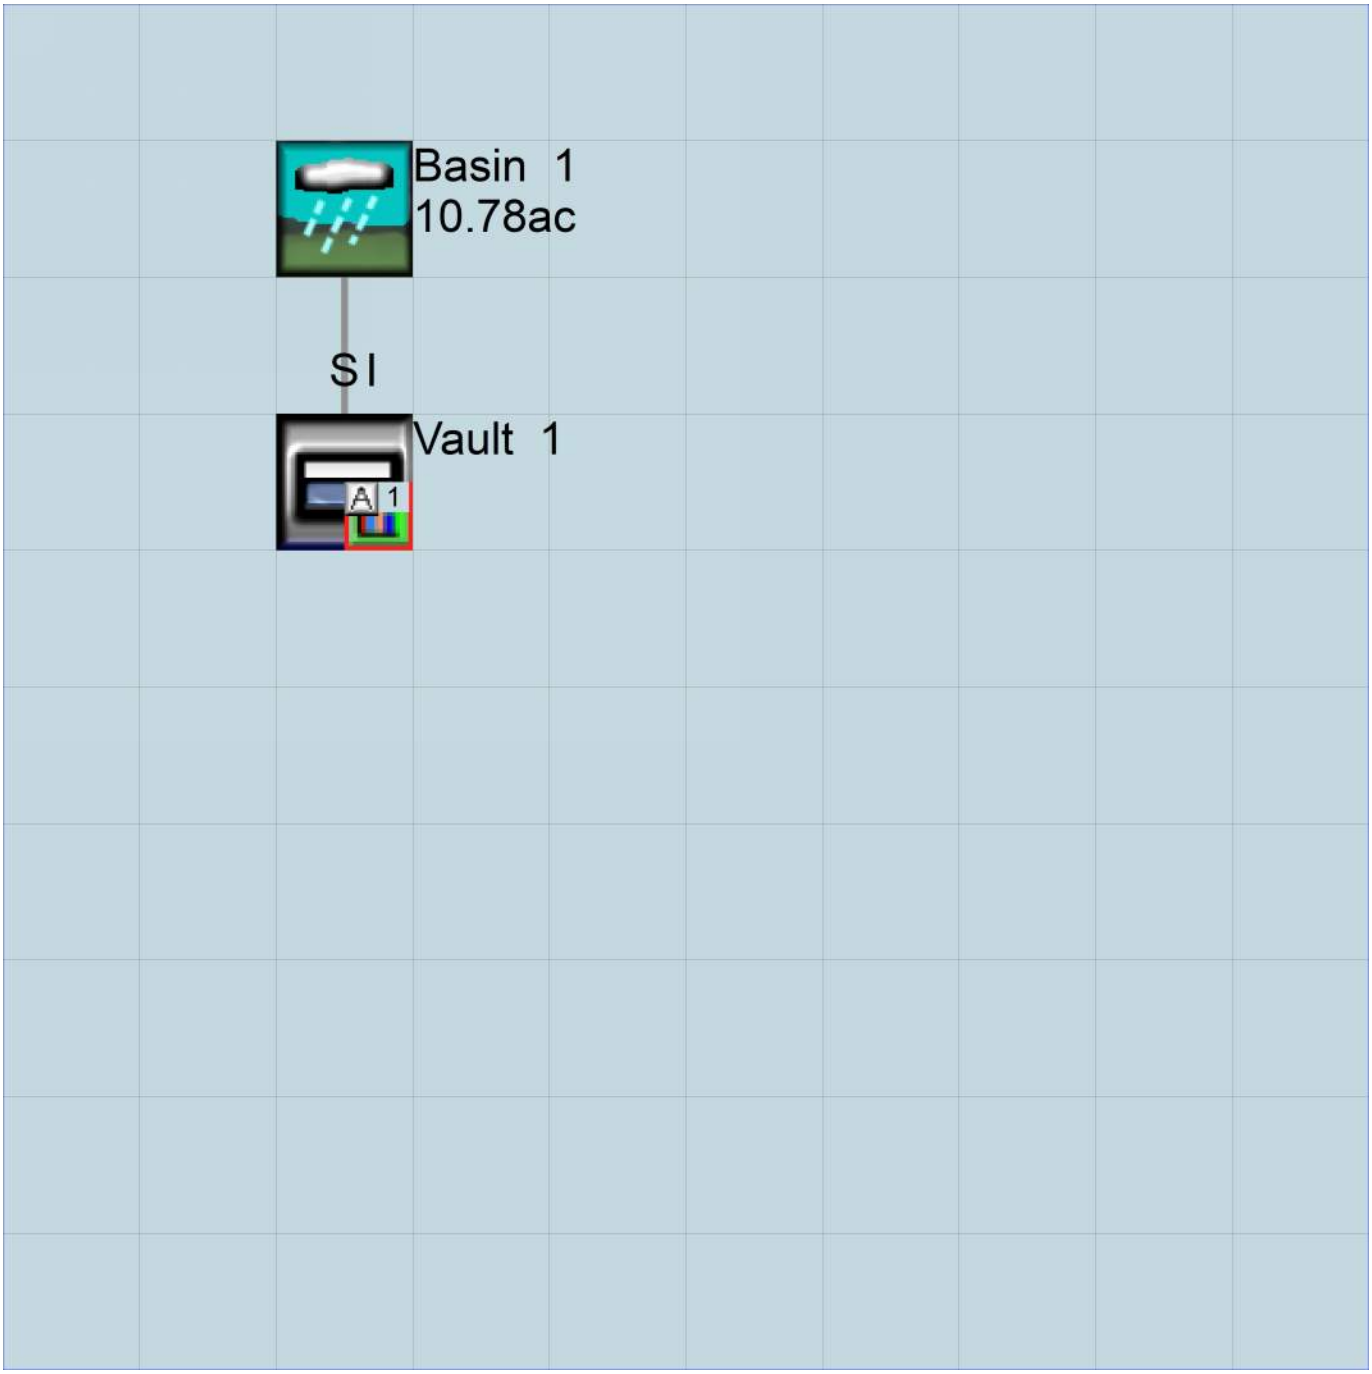

Disclaimer

Legal Notice

This program and accompanying documentation are provided 'as-is' without warranty of any kind. The entire risk regarding the performance and results of this program is assumed by End User. Clear Creek Solutions Inc. and the governmental licensee or sublicensees disclaim all warranties, either expressed or implied, including but not limited to implied warranties of program and accompanying documentation. In no event shall Clear Creek Solutions Inc. be liable for any damages whatsoever (including without limitation to damages for loss of business profits, loss of business information, business interruption, and the like) arising out of the use of, or inability to use this program even if Clear Creek Solutions Inc. or their authorized representatives have been advised of the possibility of such damages. Software Copyright © by : Clear Creek Solutions, Inc. 2005-2024; All Rights Reserved.

Clear Creek Solutions, Inc.
6200 Capitol Blvd. Ste F
Olympia, WA. 98501
Toll Free 1(866)943-0304
Local (360)943-0304

www.clearcreeksolutions.com

WWHM2012

PROJECT REPORT

FLOW CONTROL AND WATER
QUALITY CALCULATIONS
SOUTHERN ONSITE BASIN
FREEMAN LOGISTICS
BCE JOB #21585

General Model Information

WWHM2012 Project Name: 21585-CALC-DRNG-SOUTH-DETN-2024-08-13

Site Name:	FREEMAN ROAD LOGISTICS
Site Address:	
City:	PUYALLUP
Report Date:	8/13/2024
Gage:	42 IN EAST
Data Start:	1901/10/01 00:00
Data End:	2059/09/30 00:00
Timestep:	15 Minute
Precip Scale:	1.000
Version Date:	2023/01/27
Version:	4.2.19

POC Thresholds

Low Flow Threshold for POC1:	50 Percent of the 2 Year
High Flow Threshold for POC1:	50 Year

Landuse Basin Data

Predeveloped Land Use

Basin 1

Bypass:	No
GroundWater:	No
Pervious Land Use	acre
C, Forest, Flat	11.84
Pervious Total	11.84
Impervious Land Use	acre
Impervious Total	0
Basin Total	11.84

Mitigated Land Use

Basin 1

Bypass:	No
GroundWater:	No
Pervious Land Use	acre
C, Lawn, Flat	1.82
Pervious Total	1.82
Impervious Land Use	acre
ROOF TOPS FLAT	6.12
SIDEWALKS FLAT	1
PARKING FLAT	2.9
Impervious Total	10.02
Basin Total	11.84

Mitigated Routing

Vault 1

Width: 120 ft.
Length: 335 ft.
Depth: 7.5 ft.
Discharge Structure
Riser Height: 6.5 ft.
Riser Diameter: 18 in.
Orifice 1 Diameter: 1.590 in. Elevation:0 ft.
Orifice 2 Diameter: 3.110 in. Elevation:4.87 ft.
Orifice 3 Diameter: 1.860 in. Elevation:5.66 ft.
Element Flows To:
Outlet 1 Outlet 2


Vault Hydraulic Table


Stage(feet)	Area(ac.)	Volume(ac-ft.)	Discharge(cfs)	Infilt(cfs)
0.0000	0.922	0.000	0.000	0.000
0.0833	0.922	0.076	0.019	0.000
0.1667	0.922	0.153	0.028	0.000
0.2500	0.922	0.230	0.034	0.000
0.3333	0.922	0.307	0.039	0.000
0.4167	0.922	0.384	0.044	0.000
0.5000	0.922	0.461	0.048	0.000
0.5833	0.922	0.538	0.052	0.000
0.6667	0.922	0.615	0.056	0.000
0.7500	0.922	0.692	0.059	0.000
0.8333	0.922	0.769	0.062	0.000
0.9167	0.922	0.846	0.065	0.000
1.0000	0.922	0.922	0.068	0.000
1.0833	0.922	0.999	0.071	0.000
1.1667	0.922	1.076	0.074	0.000
1.2500	0.922	1.153	0.076	0.000
1.3333	0.922	1.230	0.079	0.000
1.4167	0.922	1.307	0.081	0.000
1.5000	0.922	1.384	0.084	0.000
1.5833	0.922	1.461	0.086	0.000
1.6667	0.922	1.538	0.088	0.000
1.7500	0.922	1.615	0.090	0.000
1.8333	0.922	1.691	0.092	0.000
1.9167	0.922	1.768	0.095	0.000
2.0000	0.922	1.845	0.097	0.000
2.0833	0.922	1.922	0.099	0.000
2.1667	0.922	1.999	0.101	0.000
2.2500	0.922	2.076	0.102	0.000
2.3333	0.922	2.153	0.104	0.000
2.4167	0.922	2.230	0.106	0.000
2.5000	0.922	2.307	0.108	0.000
2.5833	0.922	2.384	0.110	0.000
2.6667	0.922	2.461	0.112	0.000
2.7500	0.922	2.537	0.113	0.000
2.8333	0.922	2.614	0.115	0.000
2.9167	0.922	2.691	0.117	0.000
3.0000	0.922	2.768	0.118	0.000
3.0833	0.922	2.845	0.120	0.000

3.1667	0.922	2.922	0.122	0.000
3.2500	0.922	2.999	0.123	0.000
3.3333	0.922	3.076	0.125	0.000
3.4167	0.922	3.153	0.126	0.000
3.5000	0.922	3.230	0.128	0.000
3.5833	0.922	3.306	0.129	0.000
3.6667	0.922	3.383	0.131	0.000
3.7500	0.922	3.460	0.132	0.000
3.8333	0.922	3.537	0.134	0.000
3.9167	0.922	3.614	0.135	0.000
4.0000	0.922	3.691	0.137	0.000
4.0833	0.922	3.768	0.138	0.000
4.1667	0.922	3.845	0.140	0.000
4.2500	0.922	3.922	0.141	0.000
4.3333	0.922	3.999	0.142	0.000
4.4167	0.922	4.076	0.144	0.000
4.5000	0.922	4.152	0.145	0.000
4.5833	0.922	4.229	0.146	0.000
4.6667	0.922	4.306	0.148	0.000
4.7500	0.922	4.383	0.149	0.000
4.8333	0.922	4.460	0.150	0.000
4.9167	0.922	4.537	0.208	0.000
5.0000	0.922	4.614	0.248	0.000
5.0833	0.922	4.691	0.275	0.000
5.1667	0.922	4.768	0.298	0.000
5.2500	0.922	4.845	0.319	0.000
5.3333	0.922	4.921	0.337	0.000
5.4167	0.922	4.998	0.353	0.000
5.5000	0.922	5.075	0.369	0.000
5.5833	0.922	5.152	0.383	0.000
5.6667	0.922	5.229	0.405	0.000
5.7500	0.922	5.306	0.438	0.000
5.8333	0.922	5.383	0.462	0.000
5.9167	0.922	5.460	0.483	0.000
6.0000	0.922	5.537	0.501	0.000
6.0833	0.922	5.614	0.519	0.000
6.1667	0.922	5.691	0.536	0.000
6.2500	0.922	5.767	0.552	0.000
6.3333	0.922	5.844	0.567	0.000
6.4167	0.922	5.921	0.581	0.000
6.5000	0.922	5.998	0.596	0.000
6.5833	0.922	6.075	0.992	0.000
6.6667	0.922	6.152	1.697	0.000
6.7500	0.922	6.229	2.574	0.000
6.8333	0.922	6.306	3.531	0.000
6.9167	0.922	6.383	4.473	0.000
7.0000	0.922	6.460	5.312	0.000
7.0833	0.922	6.537	5.979	0.000
7.1667	0.922	6.613	6.451	0.000
7.2500	0.922	6.690	6.779	0.000
7.3333	0.922	6.767	7.188	0.000
7.4167	0.922	6.844	7.515	0.000
7.5000	0.922	6.921	7.827	0.000
7.5833	0.922	6.998	8.127	0.000
7.6667	0.000	0.000	8.416	0.000

Analysis Results

POC 1

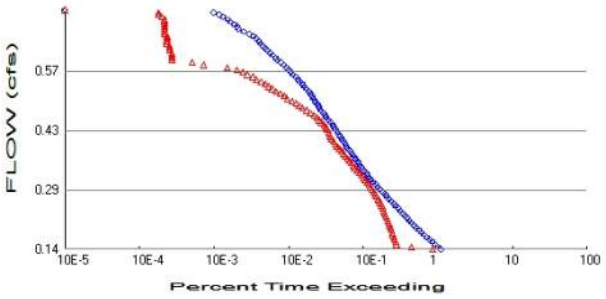

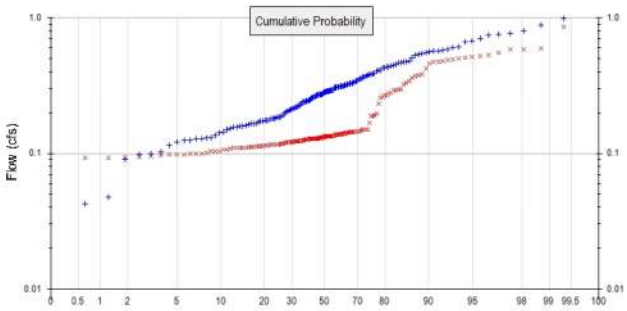

\+ Predeveloped x Mitigated

Predeveloped Landuse Totals for POC #1
Total Pervious Area: 11.84
Total Impervious Area: 0

Mitigated Landuse Totals for POC #1
Total Pervious Area: 1.82
Total Impervious Area: 10.02

Flow Frequency Method: Log Pearson Type III 17B

Flow Frequency Return Periods for Predeveloped. POC #1

Return Period	**Flow(cfs)**
2 year	0.285129
5 year	0.437453
10 year	0.53101
25 year	0.639108
50 year	0.712335
100 year	0.779698

Flow Frequency Return Periods for Mitigated. POC #1

Return Period	**Flow(cfs)**
2 year	0.14914
5 year	0.240266
10 year	0.323133
25 year	0.460094
50 year	0.590415
100 year	0.749658

WATER QUALITY DESIGN FLOW RATE EQUAL TO 2 YEAR RELEASE RATE DOWNSTREAM OF DETENTION

Annual Peaks

Annual Peaks for Predeveloped and Mitigated. POC #1

Year	**Predeveloped**	**Mitigated**
1902	0.274	0.133
1903	0.174	0.104
1904	0.322	0.124
1905	0.152	0.146
1906	0.090	0.093
1907	0.445	0.128
1908	0.314	0.112
1909	0.305	0.133
1910	0.434	0.130
1911	0.282	0.127

1912	0.982	0.143
1913	0.440	0.291
1914	0.114	0.095
1915	0.195	0.187
1916	0.285	0.123
1917	0.100	0.115
1918	0.293	0.379
1919	0.247	0.122
1920	0.289	0.126
1921	0.317	0.146
1922	0.308	0.130
1923	0.253	0.150
1924	0.125	0.116
1925	0.165	0.113
1926	0.272	0.123
1927	0.225	0.127
1928	0.215	0.138
1929	0.431	0.196
1930	0.277	0.128
1931	0.271	0.134
1932	0.203	0.145
1933	0.238	0.134
1934	0.568	0.551
1935	0.266	0.361
1936	0.257	0.140
1937	0.385	0.125
1938	0.244	0.129
1939	0.027	0.094
1940	0.267	0.146
1941	0.173	0.099
1942	0.405	0.525
1943	0.191	0.133
1944	0.431	0.255
1945	0.321	0.132
1946	0.181	0.110
1947	0.144	0.116
1948	0.599	0.133
1949	0.533	0.321
1950	0.171	0.118
1951	0.219	0.115
1952	0.766	0.331
1953	0.708	0.507
1954	0.259	0.141
1955	0.226	0.107
1956	0.128	0.108
1957	0.376	0.187
1958	0.747	0.583
1959	0.465	0.532
1960	0.131	0.100
1961	0.472	0.501
1962	0.267	0.140
1963	0.125	0.096
1964	0.149	0.110
1965	0.534	0.485
1966	0.163	0.121
1967	0.240	0.110
1968	0.262	0.144
1969	0.243	0.130

1970	0.372	0.135
1971	0.557	0.420
1972	0.366	0.137
1973	0.478	0.280
1974	0.258	0.127
1975	0.580	0.594
1976	0.319	0.135
1977	0.160	0.094
1978	0.510	0.471
1979	0.157	0.118
1980	0.307	0.128
1981	0.294	0.138
1982	0.159	0.098
1983	0.470	0.149
1984	0.220	0.120
1985	0.352	0.122
1986	0.289	0.142
1987	0.544	0.384
1988	0.339	0.297
1989	0.311	0.122
1990	0.367	0.129
1991	0.290	0.139
1992	0.358	0.372
1993	0.380	0.129
1994	0.555	0.137
1995	0.136	0.125
1996	0.606	0.491
1997	0.273	0.113
1998	0.309	0.128
1999	0.043	0.110
2000	0.234	0.144
2001	0.121	0.093
2002	0.411	0.129
2003	0.357	0.137
2004	0.305	0.133
2005	0.588	0.140
2006	0.185	0.123
2007	0.204	0.132
2008	0.309	0.128
2009	0.211	0.122
2010	0.181	0.168
2011	0.166	0.116
2012	0.282	0.123
2013	0.181	0.098
2014	0.130	0.100
2015	0.250	0.116
2016	0.102	0.115
2017	0.410	0.267
2018	0.752	0.584
2019	0.794	0.518
2020	0.239	0.113
2021	0.389	0.342
2022	0.165	0.111
2023	0.327	0.141
2024	0.880	0.127
2025	0.291	0.134
2026	0.467	0.262
2027	0.184	0.116

2028	0.157	0.098
2029	0.311	0.295
2030	0.572	0.151
2031	0.184	0.104
2032	0.127	0.101
2033	0.173	0.107
2034	0.175	0.115
2035	0.669	0.858
2036	0.344	0.143
2037	0.098	0.110
2038	0.289	0.231
2039	0.048	0.087
2040	0.175	0.120
2041	0.206	0.112
2042	0.675	0.475
2043	0.326	0.270
2044	0.425	0.277
2045	0.281	0.149
2046	0.330	0.457
2047	0.247	0.144
2048	0.326	0.128
2049	0.293	0.134
2050	0.212	0.125
2051	0.339	0.133
2052	0.185	0.131
2053	0.315	0.483
2054	0.383	0.290
2055	0.159	0.104
2056	0.142	0.112
2057	0.217	0.138
2058	0.270	0.150
2059	0.451	0.191

Ranked Annual Peaks

Ranked Annual Peaks for Predeveloped and Mitigated. POC #1

Rank	Predeveloped	Mitigated
1	0.9823	0.8584
2	0.8801	0.5943
3	0.7943	0.5842
4	0.7657	0.5827
5	0.7519	0.5511
6	0.7467	0.5323
7	0.7080	0.5249
8	0.6751	0.5182
9	0.6693	0.5072
10	0.6064	0.5006
11	0.5989	0.4905
12	0.5875	0.4845
13	0.5804	0.4827
14	0.5719	0.4754
15	0.5677	0.4708
16	0.5574	0.4568
17	0.5551	0.4196
18	0.5444	0.3840
19	0.5338	0.3791
20	0.5332	0.3715
21	0.5098	0.3606
22	0.4778	0.3417

23	0.4725	0.3312
24	0.4705	0.3212
25	0.4666	0.2968
26	0.4648	0.2947
27	0.4510	0.2914
28	0.4453	0.2901
29	0.4397	0.2802
30	0.4336	0.2770
31	0.4313	0.2699
32	0.4310	0.2674
33	0.4253	0.2616
34	0.4111	0.2554
35	0.4095	0.2312
36	0.4046	0.1958
37	0.3890	0.1907
38	0.3853	0.1873
39	0.3826	0.1872
40	0.3803	0.1680
41	0.3758	0.1507
42	0.3725	0.1503
43	0.3674	0.1498
44	0.3661	0.1490
45	0.3582	0.1489
46	0.3570	0.1459
47	0.3518	0.1459
48	0.3436	0.1457
49	0.3390	0.1447
50	0.3385	0.1444
51	0.3295	0.1436
52	0.3270	0.1436
53	0.3265	0.1435
54	0.3263	0.1433
55	0.3216	0.1422
56	0.3214	0.1414
57	0.3192	0.1409
58	0.3167	0.1404
59	0.3149	0.1398
60	0.3137	0.1396
61	0.3114	0.1386
62	0.3111	0.1383
63	0.3094	0.1382
64	0.3086	0.1375
65	0.3084	0.1373
66	0.3072	0.1373
67	0.3052	0.1369
68	0.3046	0.1354
69	0.2935	0.1348
70	0.2929	0.1343
71	0.2928	0.1342
72	0.2914	0.1341
73	0.2899	0.1336
74	0.2895	0.1335
75	0.2891	0.1332
76	0.2889	0.1330
77	0.2846	0.1330
78	0.2824	0.1329
79	0.2821	0.1328
80	0.2807	0.1323

81	0.2773	0.1316
82	0.2735	0.1306
83	0.2729	0.1301
84	0.2721	0.1297
85	0.2712	0.1295
86	0.2704	0.1294
87	0.2667	0.1289
88	0.2666	0.1288
89	0.2665	0.1287
90	0.2622	0.1284
91	0.2592	0.1283
92	0.2579	0.1283
93	0.2575	0.1282
94	0.2525	0.1277
95	0.2502	0.1276
96	0.2471	0.1275
97	0.2465	0.1272
98	0.2436	0.1269
99	0.2431	0.1266
100	0.2399	0.1262
101	0.2389	0.1254
102	0.2381	0.1247
103	0.2342	0.1245
104	0.2257	0.1238
105	0.2252	0.1234
106	0.2200	0.1228
107	0.2188	0.1226
108	0.2172	0.1225
109	0.2147	0.1220
110	0.2123	0.1220
111	0.2108	0.1218
112	0.2065	0.1217
113	0.2038	0.1214
114	0.2026	0.1199
115	0.1952	0.1195
116	0.1909	0.1182
117	0.1851	0.1182
118	0.1847	0.1163
119	0.1845	0.1162
120	0.1840	0.1161
121	0.1812	0.1158
122	0.1808	0.1156
123	0.1807	0.1154
124	0.1751	0.1153
125	0.1749	0.1152
126	0.1742	0.1149
127	0.1734	0.1133
128	0.1731	0.1127
129	0.1707	0.1126
130	0.1664	0.1123
131	0.1654	0.1119
132	0.1646	0.1118
133	0.1633	0.1108
134	0.1604	0.1104
135	0.1594	0.1103
136	0.1587	0.1098
137	0.1571	0.1096
138	0.1568	0.1095

139	0.1523	0.1082
140	0.1493	0.1074
141	0.1438	0.1068
142	0.1416	0.1041
143	0.1364	0.1039
144	0.1306	0.1037
145	0.1297	0.1012
146	0.1280	0.0998
147	0.1274	0.0996
148	0.1251	0.0990
149	0.1250	0.0978
150	0.1214	0.0976
151	0.1139	0.0975
152	0.1024	0.0961
153	0.0998	0.0952
154	0.0983	0.0943
155	0.0903	0.0941
156	0.0477	0.0927
157	0.0426	0.0925
158	0.0269	0.0866

Duration Flows

The Facility PASSED


Flow(cfs)	Predev	Mit	Percentage	Pass/Fail
0.1426	60664	47013	77	Pass
0.1483	55279	24581	44	Pass
0.1541	50415	15440	30	Pass
0.1598	46708	15047	32	Pass
0.1656	42686	14604	34	Pass
0.1713	39152	14194	36	Pass
0.1771	36033	13834	38	Pass
0.1829	33673	13523	40	Pass
0.1886	30941	13141	42	Pass
0.1944	28465	12775	44	Pass
0.2001	26360	12437	47	Pass
0.2059	24747	12194	49	Pass
0.2116	22947	11834	51	Pass
0.2174	21335	11401	53	Pass
0.2231	19856	11008	55	Pass
0.2289	18731	10731	57	Pass
0.2346	17363	10382	59	Pass
0.2404	16083	10100	62	Pass
0.2462	14936	9800	65	Pass
0.2519	14050	9496	67	Pass
0.2577	13086	9058	69	Pass
0.2634	12183	8648	70	Pass
0.2692	11329	8305	73	Pass
0.2749	10703	8011	74	Pass
0.2807	9939	7618	76	Pass
0.2864	9224	7274	78	Pass
0.2922	8554	6897	80	Pass
0.2980	8055	6604	81	Pass
0.3037	7479	6221	83	Pass
0.3095	6992	5867	83	Pass
0.3152	6565	5533	84	Pass
0.3210	6260	5253	83	Pass
0.3267	5928	4909	82	Pass
0.3325	5607	4582	81	Pass
0.3382	5284	4309	81	Pass
0.3440	5055	4080	80	Pass
0.3498	4790	3851	80	Pass
0.3555	4544	3628	79	Pass
0.3613	4300	3399	79	Pass
0.3670	4068	3193	78	Pass
0.3728	3886	3013	77	Pass
0.3785	3669	2845	77	Pass
0.3843	3450	2641	76	Pass
0.3900	3281	2488	75	Pass
0.3958	3148	2347	74	Pass
0.4016	2990	2206	73	Pass
0.4073	2833	2091	73	Pass
0.4131	2683	2012	74	Pass
0.4188	2592	1957	75	Pass
0.4246	2461	1890	76	Pass
0.4303	2361	1819	77	Pass
0.4361	2239	1743	77	Pass
0.4418	2148	1654	77	Pass

0.4476	2005	1531	76	Pass
0.4533	1878	1417	75	Pass
0.4591	1759	1312	74	Pass
0.4649	1684	1216	72	Pass
0.4706	1590	1083	68	Pass
0.4764	1509	967	64	Pass
0.4821	1430	842	58	Pass
0.4879	1373	764	55	Pass
0.4936	1302	698	53	Pass
0.4994	1237	615	49	Pass
0.5051	1185	532	44	Pass
0.5109	1125	483	42	Pass
0.5167	1081	428	39	Pass
0.5224	1027	374	36	Pass
0.5282	968	332	34	Pass
0.5339	903	299	33	Pass
0.5397	844	269	31	Pass
0.5454	785	235	29	Pass
0.5512	737	203	27	Pass
0.5569	687	183	26	Pass
0.5627	635	156	24	Pass
0.5685	589	135	22	Pass
0.5742	556	112	20	Pass
0.5800	520	83	15	Pass
0.5857	478	40	8	Pass
0.5915	435	28	6	Pass
0.5972	391	15	3	Pass
0.6030	370	15	4	Pass
0.6087	342	15	4	Pass
0.6145	310	15	4	Pass
0.6203	283	14	4	Pass
0.6260	265	14	5	Pass
0.6318	250	14	5	Pass
0.6375	234	13	5	Pass
0.6433	220	13	5	Pass
0.6490	204	13	6	Pass
0.6548	186	13	6	Pass
0.6605	163	12	7	Pass
0.6663	139	12	8	Pass
0.6720	117	12	10	Pass
0.6778	112	12	10	Pass
0.6836	103	12	11	Pass
0.6893	92	12	13	Pass
0.6951	85	12	14	Pass
0.7008	73	11	15	Pass
0.7066	65	10	15	Pass
0.7123	54	10	18	Pass

Appendix
Predeveloped Schematic



Mitigated Schematic

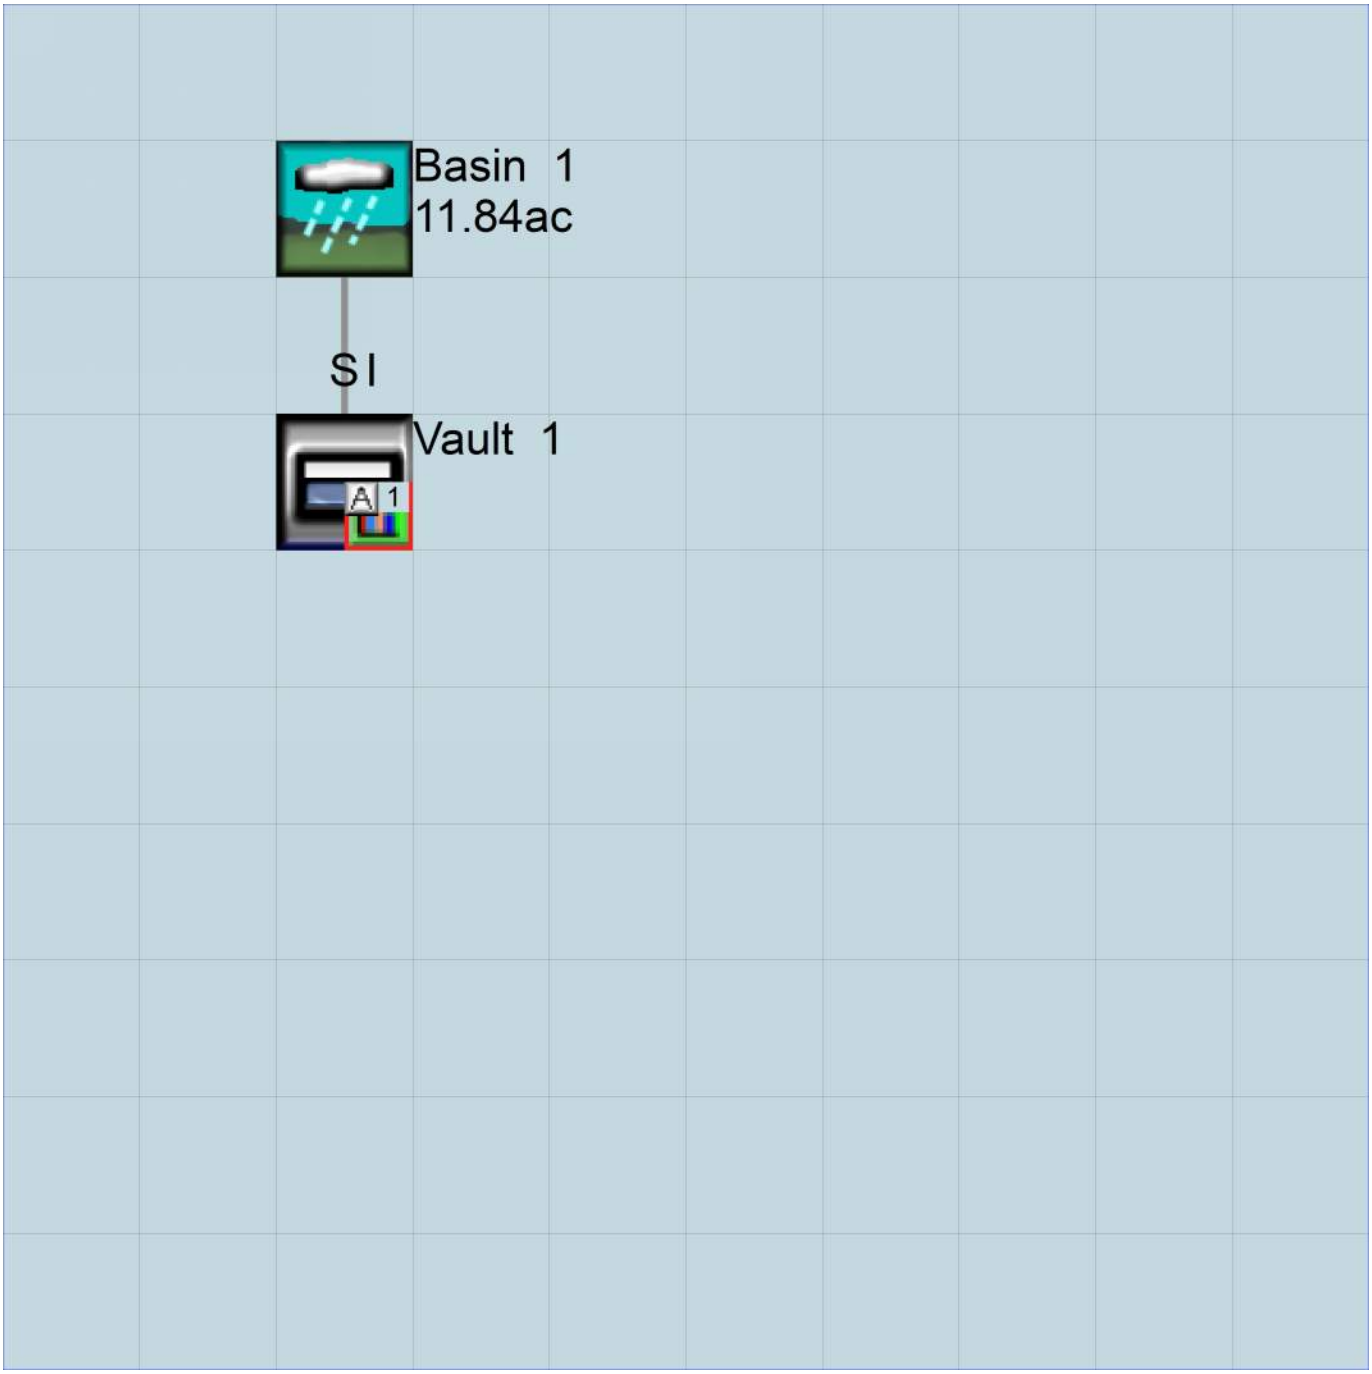

Disclaimer

Legal Notice

This program and accompanying documentation are provided 'as-is' without warranty of any kind. The entire risk regarding the performance and results of this program is assumed by End User. Clear Creek Solutions Inc. and the governmental licensee or sublicensees disclaim all warranties, either expressed or implied, including but not limited to implied warranties of program and accompanying documentation. In no event shall Clear Creek Solutions Inc. be liable for any damages whatsoever (including without limitation to damages for loss of business profits, loss of business information, business interruption, and the like) arising out of the use of, or inability to use this program even if Clear Creek Solutions Inc. or their authorized representatives have been advised of the possibility of such damages. Software Copyright © by : Clear Creek Solutions, Inc. 2005-2024; All Rights Reserved.

Clear Creek Solutions, Inc.
6200 Capitol Blvd. Ste F
Olympia, WA. 98501
Toll Free 1(866)943-0304
Local (360)943-0304

www.clearcreeksolutions.com

WWHM2012

PROJECT REPORT

FLOW CONTROL AND WQ CALCULATIONS
PUBLIC DETENTION 22ND AVE VAULT
FREEMAN LOGISTICS
BCE #21585

General Model Information

WWHM2012 Project Name: 21585-M-CALC-FRONT VAULT-2025-06-03

Site Name:	FREEMAN LOGISTICS
Site Address:	
City:	PUYALLUP
Report Date:	6/3/2025
Gage:	42 IN EAST
Data Start:	10/01/1901
Data End:	09/30/2059
Timestep:	15 Minute
Precip Scale:	1.000
Version Date:	2024/06/28
Version:	4.3.1

POC Thresholds

Low Flow Threshold for POC1:	50 Percent of the 2 Year
High Flow Threshold for POC1:	50 Year

Landuse Basin Data

Predeveloped Land Use

Basin 1

Bypass:	No
GroundWater:	No
Pervious Land Use	acre
C, Forest, Flat	2.67
Pervious Total	2.67
Impervious Land Use	acre
Impervious Total	0
Basin Total	2.67

Element Flow Componants:

Surface	Interflow	Groundwater

Componant Flows To:

POC 1	POC 1

Mitigated Land Use

Basin 1

Bypass:	No
GroundWater:	No

Pervious Land Use	acre
C, Lawn, Flat	0.26
Pervious Total	0.26

Impervious Land Use	acre
ROADS FLAT	2.1
SIDEWALKS FLAT	0.31
Impervious Total	2.41
Basin Total	2.67

Element Flow Componants:

Surface	Interflow	Groundwater

Componant Flows To:

Vault 1	Vault 1

Mitigated Routing

Vault 1

Width: 20 ft.
Length: 293 ft.
Depth: 11.5 ft.
Discharge Structure
Riser Height: 10.5 ft.
Riser Diameter: 18 in.
Orifice 1 Diameter: 0.670 in. Elevation:0 ft.
Orifice 2 Diameter: 0.890 in. Elevation:8.33 ft.
Orifice 3 Diameter: 1.590 in. Elevation:9.13 ft.
Element Outlets:
Outlet 1 Outlet 2
Outlet Flows To:


Vault Hydraulic Table


Stage(feet)	Area(ac.)	Volume(ac-ft.)	Discharge(cfs)	Infilt(cfs)
0.0000	0.134	0.000	0.000	0.000
0.1278	0.134	0.017	0.004	0.000
0.2556	0.134	0.034	0.006	0.000
0.3833	0.134	0.051	0.007	0.000
0.5111	0.134	0.068	0.008	0.000
0.6389	0.134	0.085	0.009	0.000
0.7667	0.134	0.103	0.010	0.000
0.8944	0.134	0.120	0.011	0.000
1.0222	0.134	0.137	0.012	0.000
1.1500	0.134	0.154	0.013	0.000
1.2778	0.134	0.171	0.013	0.000
1.4056	0.134	0.189	0.014	0.000
1.5333	0.134	0.206	0.015	0.000
1.6611	0.134	0.223	0.015	0.000
1.7889	0.134	0.240	0.016	0.000
1.9167	0.134	0.257	0.016	0.000
2.0444	0.134	0.275	0.017	0.000
2.1722	0.134	0.292	0.018	0.000
2.3000	0.134	0.309	0.018	0.000
2.4278	0.134	0.326	0.019	0.000
2.5556	0.134	0.343	0.019	0.000
2.6833	0.134	0.361	0.020	0.000
2.8111	0.134	0.378	0.020	0.000
2.9389	0.134	0.395	0.020	0.000
3.0667	0.134	0.412	0.021	0.000
3.1944	0.134	0.429	0.021	0.000
3.3222	0.134	0.446	0.022	0.000
3.4500	0.134	0.464	0.022	0.000
3.5778	0.134	0.481	0.023	0.000
3.7056	0.134	0.498	0.023	0.000
3.8333	0.134	0.515	0.023	0.000
3.9611	0.134	0.532	0.024	0.000
4.0889	0.134	0.550	0.024	0.000
4.2167	0.134	0.567	0.025	0.000
4.3444	0.134	0.584	0.025	0.000
4.4722	0.134	0.601	0.025	0.000
4.6000	0.134	0.618	0.026	0.000

4.7278	0.134	0.636	0.026	0.000
4.8556	0.134	0.653	0.026	0.000
4.9833	0.134	0.670	0.027	0.000
5.1111	0.134	0.687	0.027	0.000
5.2389	0.134	0.704	0.027	0.000
5.3667	0.134	0.722	0.028	0.000
5.4944	0.134	0.739	0.028	0.000
5.6222	0.134	0.756	0.028	0.000
5.7500	0.134	0.773	0.029	0.000
5.8778	0.134	0.790	0.029	0.000
6.0056	0.134	0.807	0.029	0.000
6.1333	0.134	0.825	0.030	0.000
6.2611	0.134	0.842	0.030	0.000
6.3889	0.134	0.859	0.030	0.000
6.5167	0.134	0.876	0.031	0.000
6.6444	0.134	0.893	0.031	0.000
6.7722	0.134	0.911	0.031	0.000
6.9000	0.134	0.928	0.032	0.000
7.0278	0.134	0.945	0.032	0.000
7.1556	0.134	0.962	0.032	0.000
7.2833	0.134	0.979	0.032	0.000
7.4111	0.134	0.997	0.033	0.000
7.5389	0.134	1.014	0.033	0.000
7.6667	0.134	1.031	0.033	0.000
7.7944	0.134	1.048	0.034	0.000
7.9222	0.134	1.065	0.034	0.000
8.0500	0.134	1.082	0.034	0.000
8.1778	0.134	1.100	0.034	0.000
8.3056	0.134	1.117	0.035	0.000
8.4333	0.134	1.134	0.042	0.000
8.5611	0.134	1.151	0.046	0.000
8.6889	0.134	1.168	0.048	0.000
8.8167	0.134	1.186	0.051	0.000
8.9444	0.134	1.203	0.053	0.000
9.0722	0.134	1.220	0.055	0.000
9.2000	0.134	1.237	0.075	0.000
9.3278	0.134	1.254	0.089	0.000
9.4556	0.134	1.272	0.099	0.000
9.5833	0.134	1.289	0.108	0.000
9.7111	0.134	1.306	0.115	0.000
9.8389	0.134	1.323	0.122	0.000
9.9667	0.134	1.340	0.128	0.000
10.094	0.134	1.358	0.134	0.000
10.222	0.134	1.375	0.140	0.000
10.350	0.134	1.392	0.145	0.000
10.478	0.134	1.409	0.150	0.000
10.606	0.134	1.426	0.699	0.000
10.733	0.134	1.443	1.916	0.000
10.861	0.134	1.461	3.363	0.000
10.989	0.134	1.478	4.706	0.000
11.117	0.134	1.495	5.673	0.000
11.244	0.134	1.512	6.229	0.000
11.372	0.134	1.529	6.799	0.000
11.500	0.134	1.547	7.271	0.000
11.628	0.134	1.496	7.714	0.000

Analysis Results

POC 1

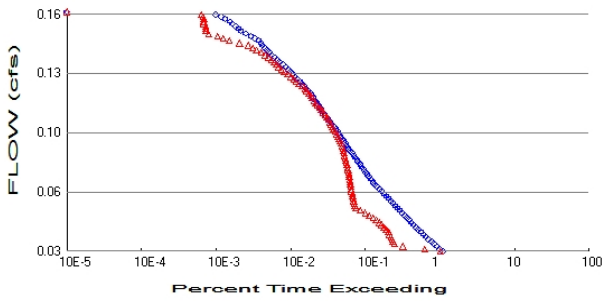

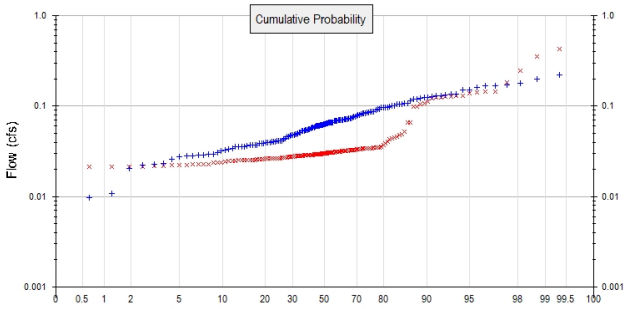

\+ Predeveloped x Mitigated

Predeveloped Landuse Totals for POC #1
Total Pervious Area: 2.67
Total Impervious Area: 0

Mitigated Landuse Totals for POC #1
Total Pervious Area: 0.26
Total Impervious Area: 2.41

Flow Frequency Method: Log Pearson Type III 17B

Flow Frequency Return Periods for Predeveloped. POC #1

Return Period	**Flow(cfs)**
2 year	0.064298
5 year	0.098649
10 year	0.119746
25 year	0.144123
50 year	0.160636
100 year	0.175827

Flow Frequency Return Periods for Mitigated. POC #1

Return Period	**Flow(cfs)**
2 year	0.032639
5 year	0.05582
10 year	0.078854
25 year	0.120068
50 year	0.162255
100 year	0.21708

WATER QUALITY DESIGN FLOW RATE

Annual Peaks

Annual Peaks for Predeveloped and Mitigated. POC #1

Year	**Predeveloped**	**Mitigated**
1902	0.062	0.030
1903	0.039	0.024
1904	0.073	0.028
1905	0.034	0.033
1906	0.020	0.021
1907	0.100	0.029
1908	0.071	0.026
1909	0.069	0.030
1910	0.098	0.030
1911	0.064	0.029

1912	0.222	0.032
1913	0.099	0.043
1914	0.026	0.022
1915	0.044	0.034
1916	0.064	0.028
1917	0.023	0.026
1918	0.066	0.099
1919	0.056	0.028
1920	0.065	0.029
1921	0.071	0.033
1922	0.070	0.030
1923	0.057	0.034
1924	0.028	0.026
1925	0.037	0.026
1926	0.061	0.028
1927	0.051	0.029
1928	0.048	0.031
1929	0.097	0.034
1930	0.063	0.029
1931	0.061	0.030
1932	0.046	0.033
1933	0.054	0.031
1934	0.128	0.182
1935	0.060	0.066
1936	0.058	0.032
1937	0.087	0.028
1938	0.055	0.029
1939	0.006	0.022
1940	0.060	0.033
1941	0.039	0.023
1942	0.091	0.131
1943	0.043	0.030
1944	0.097	0.039
1945	0.072	0.030
1946	0.041	0.025
1947	0.032	0.026
1948	0.135	0.030
1949	0.120	0.053
1950	0.038	0.027
1951	0.049	0.026
1952	0.173	0.049
1953	0.160	0.126
1954	0.058	0.032
1955	0.051	0.025
1956	0.029	0.025
1957	0.085	0.034
1958	0.168	0.246
1959	0.105	0.146
1960	0.029	0.023
1961	0.107	0.124
1962	0.060	0.032
1963	0.028	0.022
1964	0.034	0.025
1965	0.120	0.138
1966	0.037	0.028
1967	0.054	0.025
1968	0.059	0.033
1969	0.055	0.030

1970	0.084	0.031
1971	0.126	0.098
1972	0.083	0.031
1973	0.108	0.044
1974	0.058	0.029
1975	0.131	0.431
1976	0.072	0.031
1977	0.036	0.021
1978	0.115	0.125
1979	0.035	0.027
1980	0.069	0.029
1981	0.066	0.031
1982	0.036	0.022
1983	0.106	0.034
1984	0.050	0.027
1985	0.079	0.027
1986	0.065	0.032
1987	0.123	0.107
1988	0.076	0.046
1989	0.070	0.028
1990	0.083	0.029
1991	0.065	0.032
1992	0.081	0.106
1993	0.086	0.029
1994	0.125	0.031
1995	0.031	0.028
1996	0.137	0.128
1997	0.062	0.026
1998	0.070	0.029
1999	0.010	0.025
2000	0.053	0.033
2001	0.027	0.021
2002	0.093	0.029
2003	0.081	0.031
2004	0.069	0.030
2005	0.132	0.032
2006	0.042	0.028
2007	0.046	0.030
2008	0.070	0.029
2009	0.048	0.028
2010	0.041	0.034
2011	0.038	0.027
2012	0.064	0.028
2013	0.041	0.022
2014	0.029	0.023
2015	0.056	0.027
2016	0.023	0.026
2017	0.092	0.045
2018	0.170	0.146
2019	0.179	0.141
2020	0.054	0.026
2021	0.088	0.066
2022	0.037	0.025
2023	0.074	0.032
2024	0.198	0.029
2025	0.066	0.030
2026	0.105	0.035
2027	0.042	0.026

2028	0.035	0.022
2029	0.070	0.048
2030	0.129	0.034
2031	0.041	0.024
2032	0.029	0.023
2033	0.039	0.024
2034	0.039	0.026
2035	0.151	0.357
2036	0.077	0.033
2037	0.022	0.025
2038	0.065	0.035
2039	0.011	0.020
2040	0.039	0.027
2041	0.047	0.025
2042	0.152	0.113
2043	0.074	0.037
2044	0.096	0.035
2045	0.063	0.034
2046	0.074	0.130
2047	0.056	0.033
2048	0.074	0.029
2049	0.066	0.030
2050	0.048	0.029
2051	0.076	0.030
2052	0.042	0.030
2053	0.071	0.121
2054	0.086	0.040
2055	0.036	0.024
2056	0.032	0.026
2057	0.049	0.031
2058	0.061	0.034
2059	0.102	0.035

Ranked Annual Peaks

Ranked Annual Peaks for Predeveloped and Mitigated. POC #1

Rank	Predeveloped	Mitigated
1	0.2215	0.4306
2	0.1985	0.3569
3	0.1791	0.2462
4	0.1727	0.1821
5	0.1696	0.1464
6	0.1684	0.1460
7	0.1597	0.1409
8	0.1523	0.1378
9	0.1509	0.1315
10	0.1367	0.1305
11	0.1351	0.1282
12	0.1325	0.1262
13	0.1309	0.1246
14	0.1290	0.1237
15	0.1280	0.1211
16	0.1257	0.1127
17	0.1252	0.1069
18	0.1228	0.1061
19	0.1204	0.0988
20	0.1202	0.0979
21	0.1150	0.0664
22	0.1077	0.0660

23	0.1065	0.0527
24	0.1061	0.0490
25	0.1052	0.0482
26	0.1048	0.0459
27	0.1017	0.0447
28	0.1004	0.0441
29	0.0992	0.0434
30	0.0978	0.0405
31	0.0973	0.0392
32	0.0972	0.0372
33	0.0959	0.0355
34	0.0927	0.0350
35	0.0924	0.0349
36	0.0912	0.0347
37	0.0877	0.0345
38	0.0869	0.0345
39	0.0863	0.0344
40	0.0858	0.0343
41	0.0847	0.0342
42	0.0840	0.0339
43	0.0828	0.0339
44	0.0826	0.0338
45	0.0808	0.0336
46	0.0805	0.0333
47	0.0793	0.0331
48	0.0775	0.0331
49	0.0764	0.0329
50	0.0763	0.0328
51	0.0743	0.0327
52	0.0737	0.0326
53	0.0736	0.0326
54	0.0736	0.0325
55	0.0725	0.0322
56	0.0725	0.0320
57	0.0720	0.0320
58	0.0714	0.0319
59	0.0710	0.0318
60	0.0708	0.0317
61	0.0702	0.0316
62	0.0701	0.0315
63	0.0698	0.0313
64	0.0696	0.0313
65	0.0695	0.0313
66	0.0693	0.0311
67	0.0688	0.0310
68	0.0687	0.0306
69	0.0662	0.0306
70	0.0661	0.0305
71	0.0660	0.0305
72	0.0657	0.0304
73	0.0654	0.0304
74	0.0653	0.0304
75	0.0652	0.0304
76	0.0652	0.0303
77	0.0642	0.0302
78	0.0637	0.0302
79	0.0636	0.0302
80	0.0633	0.0301

81	0.0625	0.0299
82	0.0617	0.0299
83	0.0615	0.0297
84	0.0614	0.0295
85	0.0612	0.0295
86	0.0610	0.0295
87	0.0601	0.0294
88	0.0601	0.0294
89	0.0601	0.0293
90	0.0591	0.0292
91	0.0584	0.0291
92	0.0582	0.0290
93	0.0581	0.0290
94	0.0569	0.0290
95	0.0564	0.0290
96	0.0557	0.0290
97	0.0556	0.0290
98	0.0549	0.0288
99	0.0548	0.0287
100	0.0541	0.0286
101	0.0539	0.0286
102	0.0537	0.0284
103	0.0528	0.0283
104	0.0509	0.0282
105	0.0508	0.0281
106	0.0496	0.0281
107	0.0493	0.0280
108	0.0490	0.0280
109	0.0484	0.0278
110	0.0479	0.0277
111	0.0475	0.0277
112	0.0466	0.0276
113	0.0460	0.0275
114	0.0457	0.0273
115	0.0440	0.0271
116	0.0430	0.0270
117	0.0417	0.0268
118	0.0417	0.0266
119	0.0416	0.0266
120	0.0415	0.0264
121	0.0409	0.0264
122	0.0408	0.0263
123	0.0408	0.0263
124	0.0395	0.0263
125	0.0394	0.0263
126	0.0393	0.0263
127	0.0391	0.0258
128	0.0390	0.0257
129	0.0385	0.0257
130	0.0375	0.0256
131	0.0373	0.0255
132	0.0371	0.0255
133	0.0368	0.0252
134	0.0362	0.0252
135	0.0359	0.0252
136	0.0358	0.0252
137	0.0354	0.0251
138	0.0354	0.0249

139	0.0343	0.0247
140	0.0337	0.0247
141	0.0324	0.0243
142	0.0319	0.0238
143	0.0308	0.0238
144	0.0295	0.0236
145	0.0292	0.0229
146	0.0289	0.0229
147	0.0287	0.0227
148	0.0282	0.0226
149	0.0282	0.0223
150	0.0274	0.0223
151	0.0257	0.0222
152	0.0231	0.0219
153	0.0225	0.0219
154	0.0222	0.0215
155	0.0204	0.0215
156	0.0108	0.0213
157	0.0096	0.0212
158	0.0061	0.0198

Duration Flows


The Facility PASSED

Flow(cfs)	Predev	Mit	Percentage	Pass/Fail
0.0321	60110	55955	93	Pass
0.0334	55052	34465	62	Pass
0.0347	50370	17822	35	Pass
0.0360	46171	13534	29	Pass
0.0373	42337	13052	30	Pass
0.0386	38980	12637	32	Pass
0.0399	35999	12210	33	Pass
0.0412	33268	11745	35	Pass
0.0425	30686	11268	36	Pass
0.0438	28326	10537	37	Pass
0.0451	26332	9839	37	Pass
0.0464	24493	9169	37	Pass
0.0477	22781	8510	37	Pass
0.0490	21235	7745	36	Pass
0.0503	19833	7047	35	Pass
0.0516	18532	6238	33	Pass
0.0529	17207	5522	32	Pass
0.0542	16000	4692	29	Pass
0.0555	14908	4091	27	Pass
0.0568	13900	4019	28	Pass
0.0581	12980	3943	30	Pass
0.0594	12133	3871	31	Pass
0.0607	11318	3807	33	Pass
0.0620	10593	3740	35	Pass
0.0633	9850	3686	37	Pass
0.0646	9174	3636	39	Pass
0.0659	8537	3592	42	Pass
0.0672	7961	3546	44	Pass
0.0685	7429	3505	47	Pass
0.0698	6947	3463	49	Pass
0.0711	6554	3419	52	Pass
0.0724	6199	3382	54	Pass
0.0737	5895	3337	56	Pass
0.0750	5579	3293	59	Pass
0.0763	5274	3249	61	Pass
0.0776	5009	3196	63	Pass
0.0789	4759	3139	65	Pass
0.0802	4528	3080	68	Pass
0.0815	4290	3014	70	Pass
0.0828	4068	2960	72	Pass
0.0841	3861	2909	75	Pass
0.0854	3652	2860	78	Pass
0.0867	3442	2818	81	Pass
0.0880	3281	2768	84	Pass
0.0893	3124	2709	86	Pass
0.0906	2973	2632	88	Pass
0.0919	2829	2556	90	Pass
0.0931	2682	2471	92	Pass
0.0944	2575	2381	92	Pass
0.0957	2451	2296	93	Pass
0.0970	2357	2186	92	Pass
0.0983	2239	2087	93	Pass
0.0996	2140	2003	93	Pass


0.1009	1996	1920	96	Pass
0.1022	1869	1845	98	Pass
0.1035	1759	1776	100	Pass
0.1048	1673	1685	100	Pass
0.1061	1583	1593	100	Pass
0.1074	1506	1507	100	Pass
0.1087	1430	1431	100	Pass
0.1100	1354	1348	99	Pass
0.1113	1296	1255	96	Pass
0.1126	1234	1189	96	Pass
0.1139	1182	1132	95	Pass
0.1152	1119	1082	96	Pass
0.1165	1072	1029	95	Pass
0.1178	1026	964	93	Pass
0.1191	966	912	94	Pass
0.1204	895	854	95	Pass
0.1217	832	788	94	Pass
0.1230	785	717	91	Pass
0.1243	739	650	87	Pass
0.1256	681	609	89	Pass
0.1269	633	553	87	Pass
0.1282	589	506	85	Pass
0.1295	556	453	81	Pass
0.1308	514	417	81	Pass
0.1321	475	377	79	Pass
0.1334	433	353	81	Pass
0.1347	391	335	85	Pass
0.1360	368	306	83	Pass
0.1373	341	280	82	Pass
0.1386	309	249	80	Pass
0.1399	284	223	78	Pass
0.1412	266	193	72	Pass
0.1425	248	172	69	Pass
0.1438	234	149	63	Pass
0.1451	220	114	51	Pass
0.1464	205	83	40	Pass
0.1477	184	69	37	Pass
0.1490	162	58	35	Pass
0.1503	139	44	31	Pass
0.1516	118	40	33	Pass
0.1528	110	40	36	Pass
0.1541	101	40	39	Pass
0.1554	92	38	41	Pass
0.1567	85	38	44	Pass
0.1580	73	38	52	Pass
0.1593	64	37	57	Pass
0.1606	54	35	64	Pass

Appendix

Predeveloped Schematic

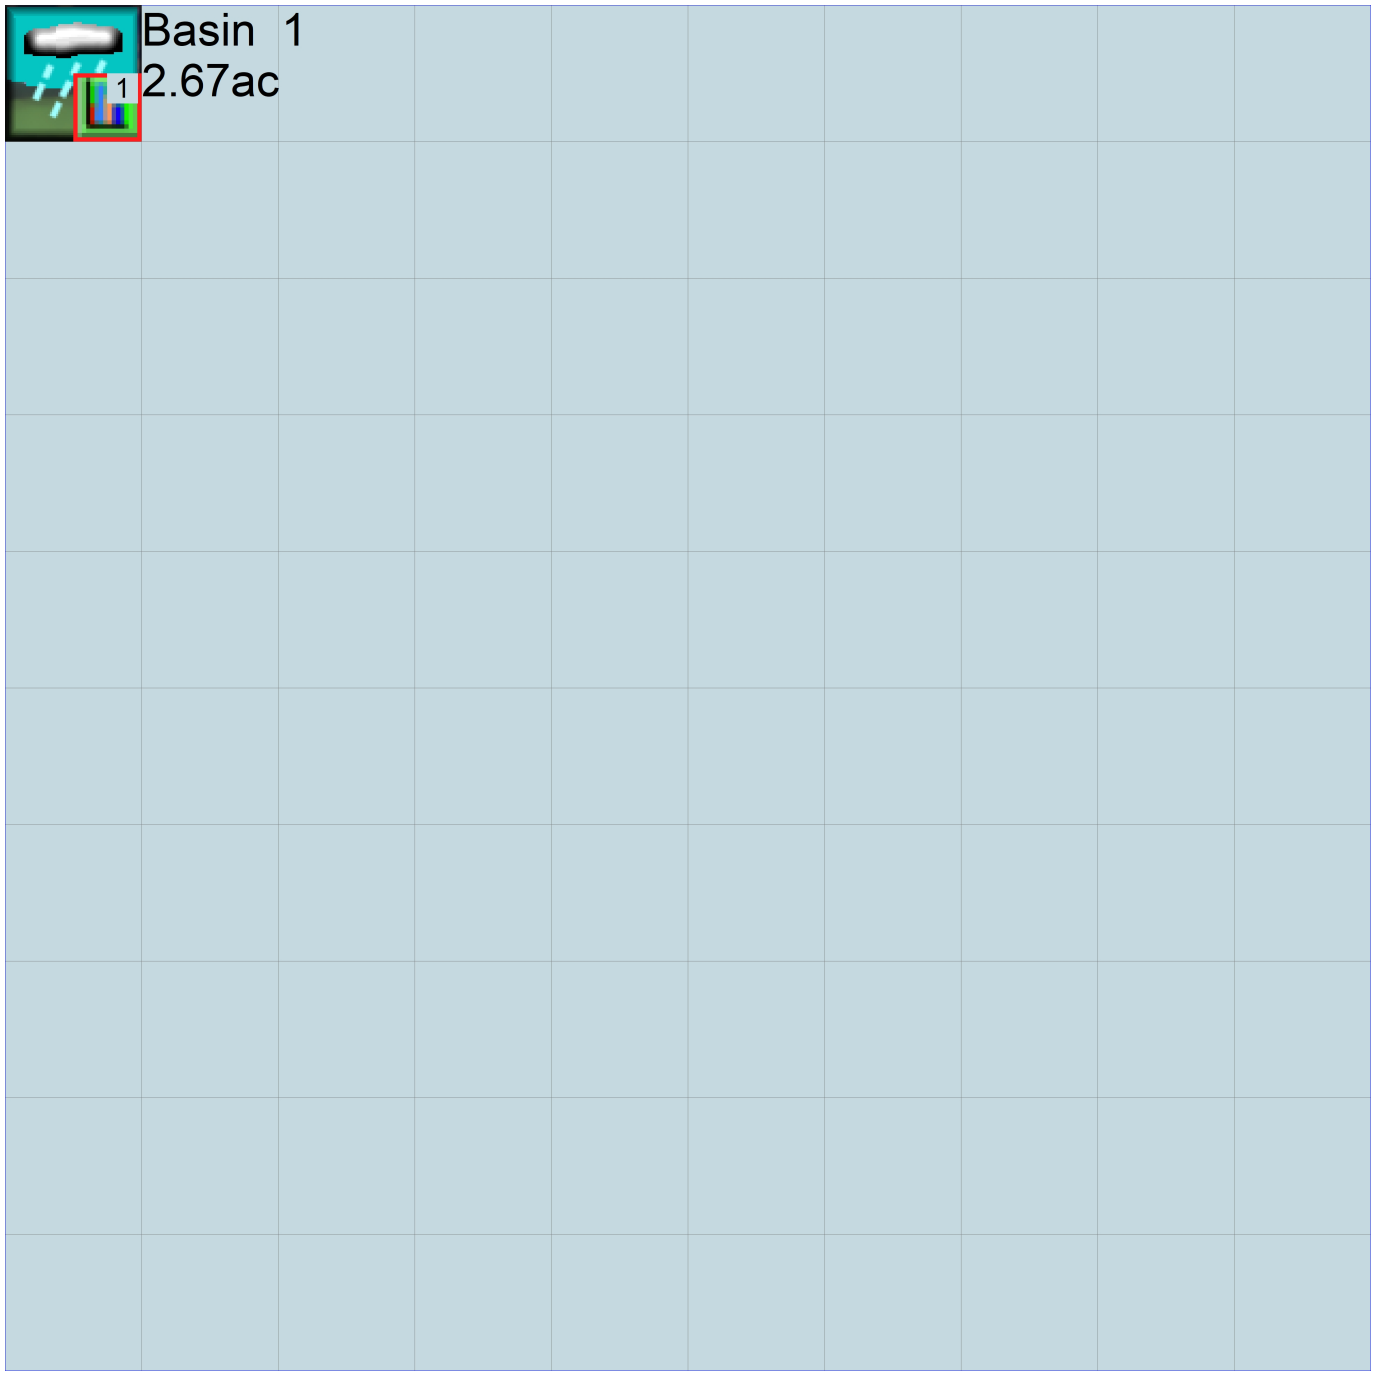

Mitigated Schematic

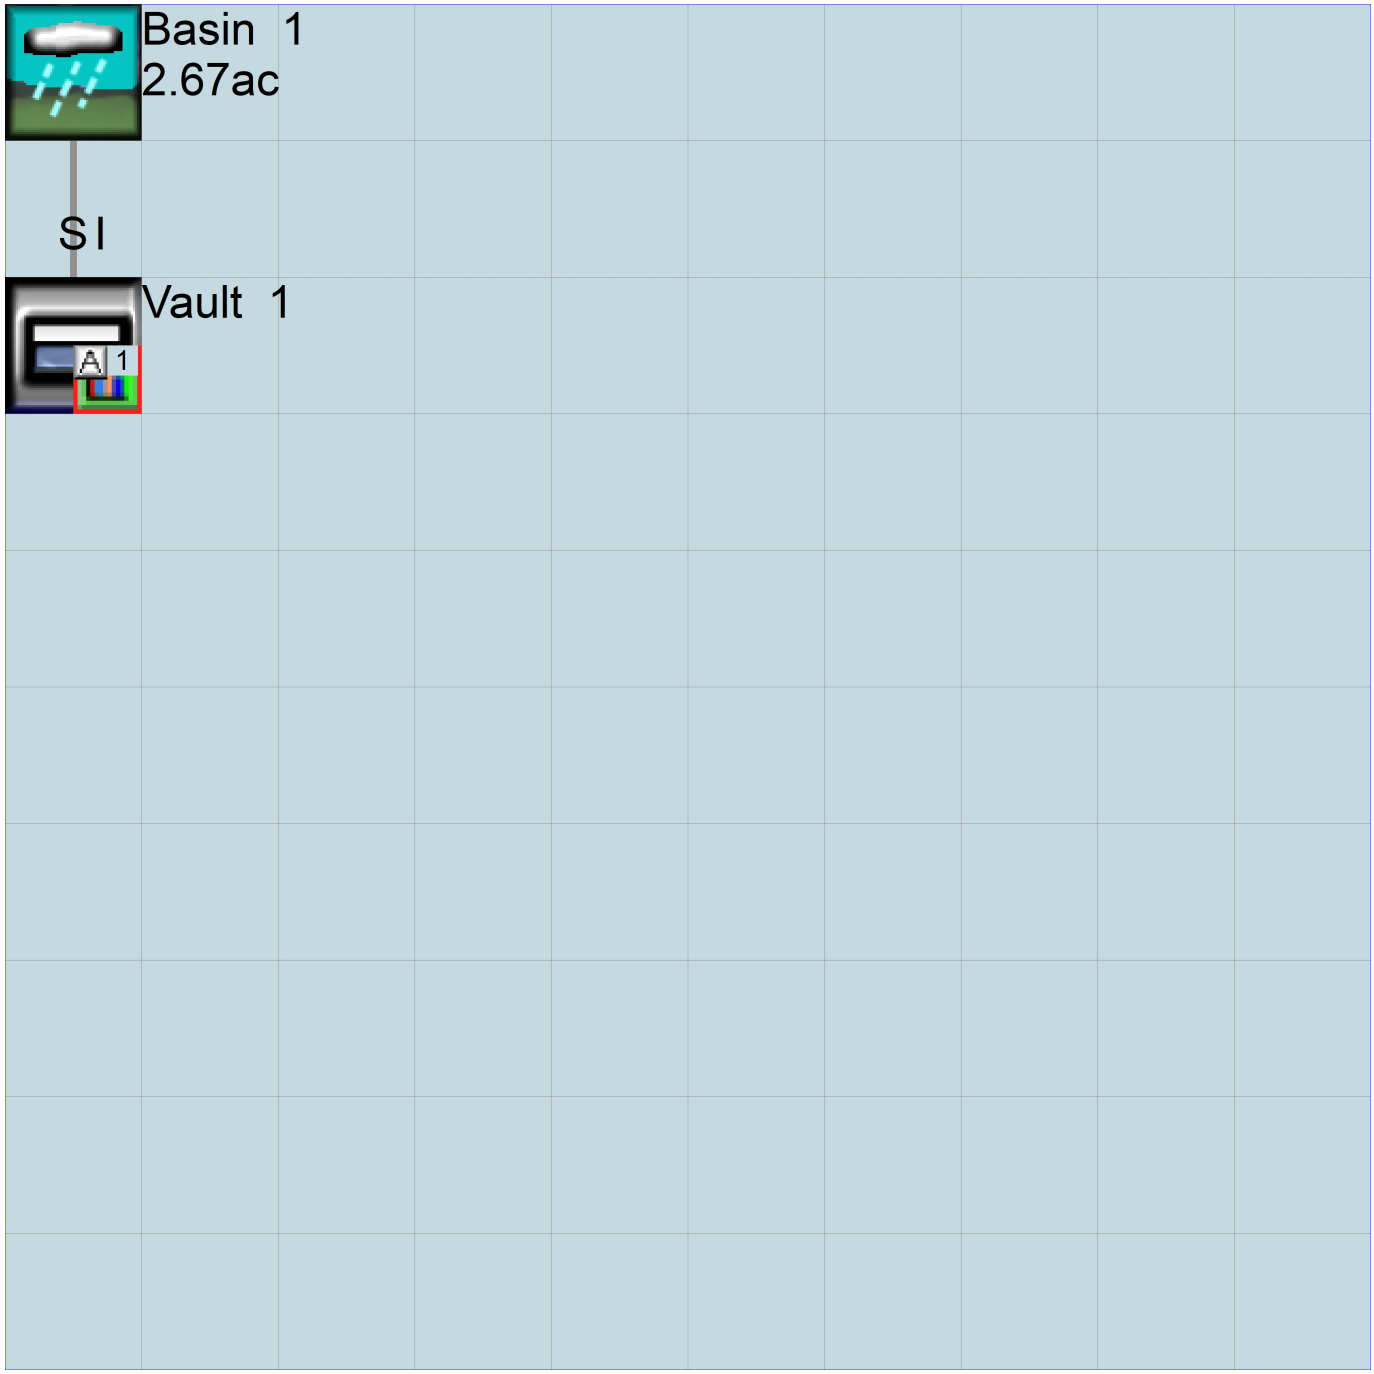

Disclaimer

Legal Notice

This program and accompanying documentation are provided 'as-is' without warranty of any kind. The entire risk regarding the performance and results of this program is assumed by End User. Clear Creek Solutions Inc. and the governmental licensee or sublicensees disclaim all warranties, either expressed or implied, including but not limited to implied warranties of program and accompanying documentation. In no event shall Clear Creek Solutions Inc. be liable for any damages whatsoever (including without limitation to damages for loss of business profits, loss of business information, business interruption, and the like) arising out of the use of, or inability to use this program even if Clear Creek Solutions Inc. or their authorized representatives have been advised of the possibility of such damages. Software Copyright © by : Clear Creek Solutions, Inc. 2005-2025; All Rights Reserved.

Clear Creek Solutions, Inc.
6200 Capitol Blvd. Ste F
Olympia, WA. 98501
Toll Free 1(866)943-0304
Local (360)943-0304

www.clearcreeksolutions.com

WWHM2012

PROJECT REPORT

FLOW CONTROL AND WQ CALCULATIONS
OFFSITE FREEMAN AND LEVEE
FREEMAN LOGISTICS
BCE #21585

General Model Information

WWHM2012 Project Name: 21585-LEVEE-2025-05-22
Site Name:
Site Address:
City:

Report Date:	5/23/2025
Gage:	42 IN EAST
Data Start:	10/01/1901
Data End:	09/30/2059
Timestep:	15 Minute
Precip Scale:	1.000
Version Date:	2024/06/28
Version:	4.3.1

POC Thresholds

Low Flow Threshold for POC1:	50 Percent of the 2 Year
High Flow Threshold for POC1:	50 Year

Landuse Basin Data

Predeveloped Land Use

Basin 1

Bypass:	No
GroundWater:	No
Pervious Land Use	acre
C, Forest, Flat	1.02
Pervious Total	1.02
Impervious Land Use	acre
Impervious Total	0
Basin Total	1.02

Element Flow Componants:

Surface	Interflow	Groundwater
Componant Flows To:		
POC 1	POC 1	

Mitigated Land Use

Basin 1

Bypass:	No
GroundWater:	No

Pervious Land Use	acre
C, Lawn, Flat	0.01
Pervious Total	0.01

Impervious Land Use	acre
ROADS FLAT	1
SIDEWALKS FLAT	0.01
Impervious Total	1.01
Basin Total	1.02

Element Flow Componants:

Surface	Interflow	Groundwater

Componant Flows To:

Surface retention 1	Surface retention 1

Mitigated Routing

Bioretention 1

Feet?

Is this the infiltration rate of the bioretention mix?

Bottom Length:	231.00 ft.
Bottom Width:	17.00 ft.
Material thickness of first layer:	1.5
Material type for first layer:	SMMWW 12 in/hr
Material thickness of second layer:	0
Material type for second layer:	Sand
Material thickness of third layer:	0
Material type for third layer:	GRAVEL
Infiltration On	
Infiltration rate:	1.5
Infiltration safety factor:	1
Total Volume Infiltrated (ac-ft.):	483.47
Total Volume Through Riser (ac-ft.):	0.189
Total Volume Through Facility (ac-ft.):	483.659
Percent Infiltrated:	99.96
Total Precip Applied to Facility:	54.574
Total Evap From Facility:	30.341
Underdrain not used	
Discharge Structure	
Riser Height:	0.5 ft.
Riser Diameter:	18 in.
Element Outlets:	
Outlet 1	Outlet 2
Outlet Flows To:	

Bioretention Hydraulic Table

Stage(feet)	Area(ac.)	Volume(ac-ft.)	Discharge(cfs)	Infilt(cfs)
0.0000	0.1433	0.0000	0.0000	0.0000
0.0330	0.1426	0.0014	0.0000	0.0000
0.0659	0.1414	0.0028	0.0000	0.0000
0.0989	0.1402	0.0042	0.0000	0.0000
0.1319	0.1390	0.0056	0.0000	0.0000
0.1648	0.1378	0.0070	0.0000	0.0012
0.1978	0.1366	0.0085	0.0000	0.0019
0.2308	0.1354	0.0099	0.0000	0.0027
0.2637	0.1342	0.0114	0.0000	0.0038
0.2967	0.1330	0.0129	0.0000	0.0050
0.3297	0.1319	0.0144	0.0000	0.0065
0.3626	0.1307	0.0160	0.0000	0.0082
0.3956	0.1295	0.0175	0.0000	0.0101
0.4286	0.1283	0.0191	0.0000	0.0123
0.4615	0.1271	0.0207	0.0000	0.0147
0.4945	0.1259	0.0223	0.0000	0.0174
0.5275	0.1247	0.0239	0.0000	0.0204
0.5604	0.1236	0.0256	0.0000	0.0237
0.5934	0.1224	0.0272	0.0000	0.0273
0.6264	0.1212	0.0289	0.0000	0.0312
0.6593	0.1200	0.0306	0.0000	0.0353
0.6923	0.1189	0.0323	0.0000	0.0399
0.7253	0.1177	0.0341	0.0000	0.0447
0.7582	0.1165	0.0358	0.0000	0.0499
0.7912	0.1154	0.0376	0.0000	0.0554

0.8242	0.1142	0.0394	0.0000	0.0613
0.8571	0.1130	0.0412	0.0000	0.0675
0.8901	0.1119	0.0430	0.0000	0.0741
0.9231	0.1107	0.0448	0.0000	0.0811
0.9560	0.1096	0.0467	0.0000	0.0885
0.9890	0.1084	0.0485	0.0000	0.0962
1.0220	0.1072	0.0504	0.0000	0.1043
1.0549	0.1061	0.0523	0.0000	0.1129
1.0879	0.1049	0.0543	0.0000	0.1218
1.1209	0.1038	0.0562	0.0000	0.1311
1.1538	0.1026	0.0582	0.0000	0.1364
1.1868	0.1015	0.0601	0.0000	0.1364
1.2198	0.1004	0.0621	0.0000	0.1364
1.2527	0.0992	0.0642	0.0000	0.1364
1.2857	0.0981	0.0662	0.0000	0.1364
1.3187	0.0969	0.0682	0.0000	0.1364
1.3516	0.0958	0.0703	0.0000	0.1364
1.3846	0.0947	0.0724	0.0000	0.1364
1.4176	0.0935	0.0745	0.0000	0.1364
1.4505	0.0924	0.0766	0.0000	0.1364
1.4835	0.0913	0.0788	0.0000	0.1364
1.5000	0.0902	0.0798	0.0000	0.1364


Bioretention Surface Hydraulic Table


Stage(feet)	Area(ac.)	Volume(ac-ft.)	Discharge(cfs)	To Amended(cfs)	Infilt(cfs)
1.5000	0.1433	0.0798	0.0000	0.2727	0.0000
1.5330	0.1445	0.0846	0.0000	0.2727	0.0000
1.5659	0.1457	0.0894	0.0000	0.2847	0.0000
1.5989	0.1469	0.0942	0.0000	0.2907	0.0000
1.6319	0.1481	0.0990	0.0000	0.2967	0.0000
1.6648	0.1493	0.1040	0.0000	0.3027	0.0000
1.6978	0.1505	0.1089	0.0000	0.3087	0.0000
1.7308	0.1517	0.1139	0.0000	0.3147	0.0000
1.7637	0.1530	0.1189	0.0000	0.3207	0.0000
1.7967	0.1542	0.1240	0.0000	0.3267	0.0000
1.8297	0.1554	0.1291	0.0000	0.3326	0.0000
1.8626	0.1566	0.1342	0.0000	0.3386	0.0000
1.8956	0.1579	0.1394	0.0000	0.3446	0.0000
1.9286	0.1591	0.1446	0.0000	0.3506	0.0000
1.9615	0.1603	0.1499	0.0000	0.3566	0.0000
1.9945	0.1616	0.1552	0.0000	0.3626	0.0000
2.0275	0.1628	0.1605	0.0725	0.3636	0.0000
2.0604	0.1640	0.1659	0.2363	0.3636	0.0000
2.0934	0.1653	0.1714	0.4535	0.3636	0.0000
2.1264	0.1665	0.1768	0.7123	0.3636	0.0000
2.1593	0.1678	0.1823	1.0052	0.3636	0.0000
2.1923	0.1690	0.1879	1.3261	0.3636	0.0000
2.2253	0.1703	0.1935	1.6695	0.3636	0.0000
2.2582	0.1715	0.1991	2.0298	0.3636	0.0000
2.2912	0.1728	0.2048	2.4011	0.3636	0.0000
2.3242	0.1740	0.2105	2.7777	0.3636	0.0000
2.3571	0.1753	0.2163	3.1538	0.3636	0.0000
2.3901	0.1765	0.2221	3.5234	0.3636	0.0000
2.4231	0.1778	0.2279	3.8809	0.3636	0.0000
2.4560	0.1790	0.2338	4.2210	0.3636	0.0000
2.4890	0.1803	0.2397	4.5388	0.3636	0.0000
2.5220	0.1816	0.2457	4.8304	0.3636	0.0000
2.5549	0.1828	0.2517	5.0928	0.3636	0.0000

2.5879	0.1841	0.2577	5.3242	0.3636	0.0000
2.6209	0.1854	0.2638	5.5245	0.3636	0.0000
2.6538	0.1866	0.2699	5.6953	0.3636	0.0000
2.6868	0.1879	0.2761	5.8404	0.3636	0.0000
2.7198	0.1892	0.2823	5.9660	0.3636	0.0000
2.7527	0.1904	0.2886	6.1485	0.3636	0.0000
2.7857	0.1917	0.2949	6.2817	0.3636	0.0000
2.8187	0.1930	0.3012	6.4121	0.3636	0.0000
2.8516	0.1943	0.3076	6.5399	0.3636	0.0000
2.8846	0.1956	0.3140	6.6653	0.3636	0.0000
2.9176	0.1969	0.3205	6.7884	0.3636	0.0000
2.9505	0.1981	0.3270	6.9092	0.3636	0.0000
2.9835	0.1994	0.3336	7.0280	0.3636	0.0000
3.0000	0.2001	0.3369	7.1448	0.3636	0.0000

Analysis Results

POC 1

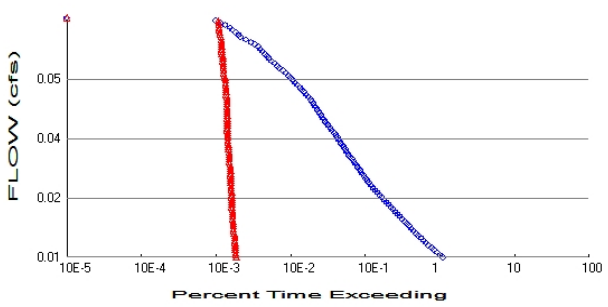

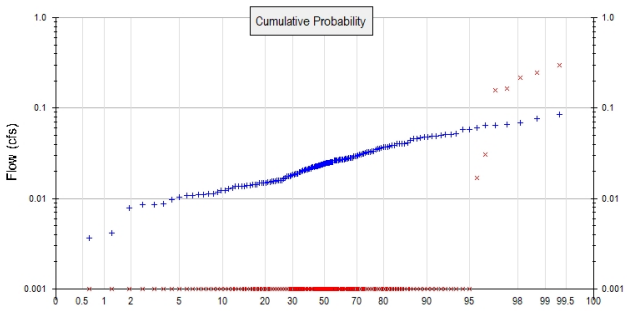

\+ Predeveloped x Mitigated

Predeveloped Landuse Totals for POC #1
Total Pervious Area: 1.02
Total Impervious Area: 0

Mitigated Landuse Totals for POC #1
Total Pervious Area: 0.01
Total Impervious Area: 1.01

Flow Frequency Method: Log Pearson Type III 17B

Flow Frequency Return Periods for Predeveloped. POC #1

Return Period	**Flow(cfs)**
2 year	0.024563
5 year	0.037686
10 year	0.045746
25 year	0.055058
50 year	0.061367
100 year	0.06717

Flow Frequency Return Periods for Mitigated. POC #1

Return Period	**Flow(cfs)**
2 year	0
5 year	0
10 year	0
25 year	0
50 year	0
100 year	0

Annual Peaks

Annual Peaks for Predeveloped and Mitigated. POC #1

Year	**Predeveloped**	**Mitigated**
1902	0.024	0.000
1903	0.015	0.000
1904	0.028	0.000
1905	0.013	0.000
1906	0.008	0.000
1907	0.038	0.000
1908	0.027	0.000
1909	0.026	0.000
1910	0.037	0.000
1911	0.024	0.000

1912	0.085	0.000
1913	0.038	0.000
1914	0.010	0.000
1915	0.017	0.000
1916	0.025	0.000
1917	0.009	0.000
1918	0.025	0.000
1919	0.021	0.000
1920	0.025	0.000
1921	0.027	0.000
1922	0.027	0.000
1923	0.022	0.000
1924	0.011	0.000
1925	0.014	0.000
1926	0.023	0.000
1927	0.019	0.000
1928	0.018	0.000
1929	0.037	0.000
1930	0.024	0.000
1931	0.023	0.000
1932	0.017	0.000
1933	0.021	0.000
1934	0.049	0.000
1935	0.023	0.000
1936	0.022	0.000
1937	0.033	0.000
1938	0.021	0.000
1939	0.002	0.000
1940	0.023	0.000
1941	0.015	0.000
1942	0.035	0.000
1943	0.016	0.000
1944	0.037	0.166
1945	0.028	0.000
1946	0.016	0.000
1947	0.012	0.000
1948	0.052	0.000
1949	0.046	0.000
1950	0.015	0.000
1951	0.019	0.000
1952	0.066	0.247
1953	0.061	0.159
1954	0.022	0.000
1955	0.019	0.000
1956	0.011	0.000
1957	0.032	0.000
1958	0.064	0.000
1959	0.040	0.000
1960	0.011	0.000
1961	0.041	0.000
1962	0.023	0.000
1963	0.011	0.000
1964	0.013	0.000
1965	0.046	0.000
1966	0.014	0.000
1967	0.021	0.000
1968	0.023	0.000
1969	0.021	0.000

1970	0.032	0.000
1971	0.048	0.000
1972	0.032	0.000
1973	0.041	0.000
1974	0.022	0.000
1975	0.050	0.000
1976	0.027	0.000
1977	0.014	0.000
1978	0.044	0.000
1979	0.014	0.000
1980	0.026	0.000
1981	0.025	0.000
1982	0.014	0.000
1983	0.041	0.000
1984	0.019	0.000
1985	0.030	0.000
1986	0.025	0.000
1987	0.047	0.000
1988	0.029	0.000
1989	0.027	0.000
1990	0.032	0.000
1991	0.025	0.000
1992	0.031	0.000
1993	0.033	0.000
1994	0.048	0.000
1995	0.012	0.000
1996	0.052	0.000
1997	0.024	0.000
1998	0.027	0.000
1999	0.004	0.000
2000	0.020	0.000
2001	0.010	0.000
2002	0.035	0.000
2003	0.031	0.000
2004	0.026	0.000
2005	0.051	0.000
2006	0.016	0.000
2007	0.018	0.000
2008	0.027	0.000
2009	0.018	0.000
2010	0.016	0.000
2011	0.014	0.000
2012	0.024	0.000
2013	0.016	0.000
2014	0.011	0.000
2015	0.022	0.000
2016	0.009	0.000
2017	0.035	0.030
2018	0.065	0.000
2019	0.068	0.300
2020	0.021	0.000
2021	0.034	0.000
2022	0.014	0.000
2023	0.028	0.000
2024	0.076	0.000
2025	0.025	0.000
2026	0.040	0.000
2027	0.016	0.000

2028	0.014	0.000
2029	0.027	0.000
2030	0.049	0.000
2031	0.016	0.000
2032	0.011	0.000
2033	0.015	0.000
2034	0.015	0.000
2035	0.058	0.017
2036	0.030	0.000
2037	0.008	0.000
2038	0.025	0.000
2039	0.004	0.000
2040	0.015	0.000
2041	0.018	0.000
2042	0.058	0.218
2043	0.028	0.000
2044	0.037	0.000
2045	0.024	0.000
2046	0.028	0.000
2047	0.021	0.000
2048	0.028	0.000
2049	0.025	0.000
2050	0.018	0.000
2051	0.029	0.000
2052	0.016	0.000
2053	0.027	0.000
2054	0.033	0.000
2055	0.014	0.000
2056	0.012	0.000
2057	0.019	0.000
2058	0.023	0.000
2059	0.039	0.000

Ranked Annual Peaks

Ranked Annual Peaks for Predeveloped and Mitigated. POC #1

Rank	Predeveloped	Mitigated
1	0.0846	0.2998
2	0.0758	0.2470
3	0.0684	0.2179
4	0.0660	0.1655
5	0.0648	0.1588
6	0.0643	0.0305
7	0.0610	0.0169
8	0.0582	0.0000
9	0.0577	0.0000
10	0.0522	0.0000
11	0.0516	0.0000
12	0.0506	0.0000
13	0.0500	0.0000
14	0.0493	0.0000
15	0.0489	0.0000
16	0.0480	0.0000
17	0.0478	0.0000
18	0.0469	0.0000
19	0.0460	0.0000
20	0.0459	0.0000
21	0.0439	0.0000
22	0.0412	0.0000

23	0.0407	0.0000
24	0.0405	0.0000
25	0.0402	0.0000
26	0.0400	0.0000
27	0.0389	0.0000
28	0.0384	0.0000
29	0.0379	0.0000
30	0.0374	0.0000
31	0.0372	0.0000
32	0.0371	0.0000
33	0.0366	0.0000
34	0.0354	0.0000
35	0.0353	0.0000
36	0.0349	0.0000
37	0.0335	0.0000
38	0.0332	0.0000
39	0.0330	0.0000
40	0.0328	0.0000
41	0.0324	0.0000
42	0.0321	0.0000
43	0.0316	0.0000
44	0.0315	0.0000
45	0.0309	0.0000
46	0.0308	0.0000
47	0.0303	0.0000
48	0.0296	0.0000
49	0.0292	0.0000
50	0.0292	0.0000
51	0.0284	0.0000
52	0.0282	0.0000
53	0.0281	0.0000
54	0.0281	0.0000
55	0.0277	0.0000
56	0.0277	0.0000
57	0.0275	0.0000
58	0.0273	0.0000
59	0.0271	0.0000
60	0.0270	0.0000
61	0.0268	0.0000
62	0.0268	0.0000
63	0.0267	0.0000
64	0.0266	0.0000
65	0.0266	0.0000
66	0.0265	0.0000
67	0.0263	0.0000
68	0.0262	0.0000
69	0.0253	0.0000
70	0.0252	0.0000
71	0.0252	0.0000
72	0.0251	0.0000
73	0.0250	0.0000
74	0.0249	0.0000
75	0.0249	0.0000
76	0.0249	0.0000
77	0.0245	0.0000
78	0.0243	0.0000
79	0.0243	0.0000
80	0.0242	0.0000

81	0.0239	0.0000
82	0.0236	0.0000
83	0.0235	0.0000
84	0.0234	0.0000
85	0.0234	0.0000
86	0.0233	0.0000
87	0.0230	0.0000
88	0.0230	0.0000
89	0.0230	0.0000
90	0.0226	0.0000
91	0.0223	0.0000
92	0.0222	0.0000
93	0.0222	0.0000
94	0.0218	0.0000
95	0.0216	0.0000
96	0.0213	0.0000
97	0.0212	0.0000
98	0.0210	0.0000
99	0.0209	0.0000
100	0.0207	0.0000
101	0.0206	0.0000
102	0.0205	0.0000
103	0.0202	0.0000
104	0.0194	0.0000
105	0.0194	0.0000
106	0.0190	0.0000
107	0.0188	0.0000
108	0.0187	0.0000
109	0.0185	0.0000
110	0.0183	0.0000
111	0.0182	0.0000
112	0.0178	0.0000
113	0.0176	0.0000
114	0.0175	0.0000
115	0.0168	0.0000
116	0.0164	0.0000
117	0.0159	0.0000
118	0.0159	0.0000
119	0.0159	0.0000
120	0.0159	0.0000
121	0.0156	0.0000
122	0.0156	0.0000
123	0.0156	0.0000
124	0.0151	0.0000
125	0.0151	0.0000
126	0.0150	0.0000
127	0.0149	0.0000
128	0.0149	0.0000
129	0.0147	0.0000
130	0.0143	0.0000
131	0.0142	0.0000
132	0.0142	0.0000
133	0.0141	0.0000
134	0.0138	0.0000
135	0.0137	0.0000
136	0.0137	0.0000
137	0.0135	0.0000
138	0.0135	0.0000

139	0.0131	0.0000
140	0.0129	0.0000
141	0.0124	0.0000
142	0.0122	0.0000
143	0.0117	0.0000
144	0.0113	0.0000
145	0.0112	0.0000
146	0.0110	0.0000
147	0.0110	0.0000
148	0.0108	0.0000
149	0.0108	0.0000
150	0.0105	0.0000
151	0.0098	0.0000
152	0.0088	0.0000
153	0.0086	0.0000
154	0.0085	0.0000
155	0.0078	0.0000
156	0.0041	0.0000
157	0.0037	0.0000
158	0.0023	0.0000


Duration Flows

The Facility PASSED

Flow(cfs)	Predev	Mit	Percentage	Pass/Fail
0.0123	60110	103	0	Pass
0.0128	55096	101	0	Pass
0.0133	50381	101	0	Pass
0.0138	46237	100	0	Pass
0.0143	42370	100	0	Pass
0.0148	38963	100	0	Pass
0.0153	36021	100	0	Pass
0.0158	33274	99	0	Pass
0.0162	30725	98	0	Pass
0.0167	28332	98	0	Pass
0.0172	26360	96	0	Pass
0.0177	24509	94	0	Pass
0.0182	22781	94	0	Pass
0.0187	21252	94	0	Pass
0.0192	19833	94	0	Pass
0.0197	18548	94	0	Pass
0.0202	17219	92	0	Pass
0.0207	16000	92	0	Pass
0.0212	14925	92	0	Pass
0.0217	13900	92	0	Pass
0.0222	12991	91	0	Pass
0.0227	12133	90	0	Pass
0.0232	11324	90	0	Pass
0.0237	10593	90	0	Pass
0.0242	9850	90	0	Pass
0.0247	9180	90	0	Pass
0.0252	8537	90	1	Pass
0.0257	7978	90	1	Pass
0.0262	7435	88	1	Pass
0.0267	6942	88	1	Pass
0.0272	6559	88	1	Pass
0.0277	6199	87	1	Pass
0.0281	5900	87	1	Pass
0.0286	5579	87	1	Pass
0.0291	5277	87	1	Pass
0.0296	5010	87	1	Pass
0.0301	4759	87	1	Pass
0.0306	4528	86	1	Pass
0.0311	4289	86	2	Pass
0.0316	4074	85	2	Pass
0.0321	3861	83	2	Pass
0.0326	3657	83	2	Pass
0.0331	3443	83	2	Pass
0.0336	3281	83	2	Pass
0.0341	3127	83	2	Pass
0.0346	2975	81	2	Pass
0.0351	2829	81	2	Pass
0.0356	2683	81	3	Pass
0.0361	2575	79	3	Pass
0.0366	2452	79	3	Pass
0.0371	2357	79	3	Pass
0.0376	2239	79	3	Pass
0.0381	2140	79	3	Pass

0.0386	1993	78	3	Pass
0.0391	1869	78	4	Pass
0.0396	1757	78	4	Pass
0.0400	1673	78	4	Pass
0.0405	1583	78	4	Pass
0.0410	1506	78	5	Pass
0.0415	1429	78	5	Pass
0.0420	1353	77	5	Pass
0.0425	1295	77	5	Pass
0.0430	1234	77	6	Pass
0.0435	1182	77	6	Pass
0.0440	1118	77	6	Pass
0.0445	1074	77	7	Pass
0.0450	1026	77	7	Pass
0.0455	966	77	7	Pass
0.0460	896	76	8	Pass
0.0465	832	76	9	Pass
0.0470	781	75	9	Pass
0.0475	735	75	10	Pass
0.0480	678	74	10	Pass
0.0485	630	74	11	Pass
0.0490	589	74	12	Pass
0.0495	555	73	13	Pass
0.0500	510	71	13	Pass
0.0505	475	70	14	Pass
0.0510	431	70	16	Pass
0.0515	389	69	17	Pass
0.0519	367	69	18	Pass
0.0524	340	69	20	Pass
0.0529	304	68	22	Pass
0.0534	280	68	24	Pass
0.0539	265	68	25	Pass
0.0544	247	66	26	Pass
0.0549	233	66	28	Pass
0.0554	218	66	30	Pass
0.0559	204	66	32	Pass
0.0564	182	65	35	Pass
0.0569	161	65	40	Pass
0.0574	139	65	46	Pass
0.0579	117	64	54	Pass
0.0584	110	62	56	Pass
0.0589	101	62	61	Pass
0.0594	92	61	66	Pass
0.0599	85	61	71	Pass
0.0604	73	60	82	Pass
0.0609	62	60	96	Pass
0.0614	54	59	109	Pass

Appendix
Predeveloped Schematic

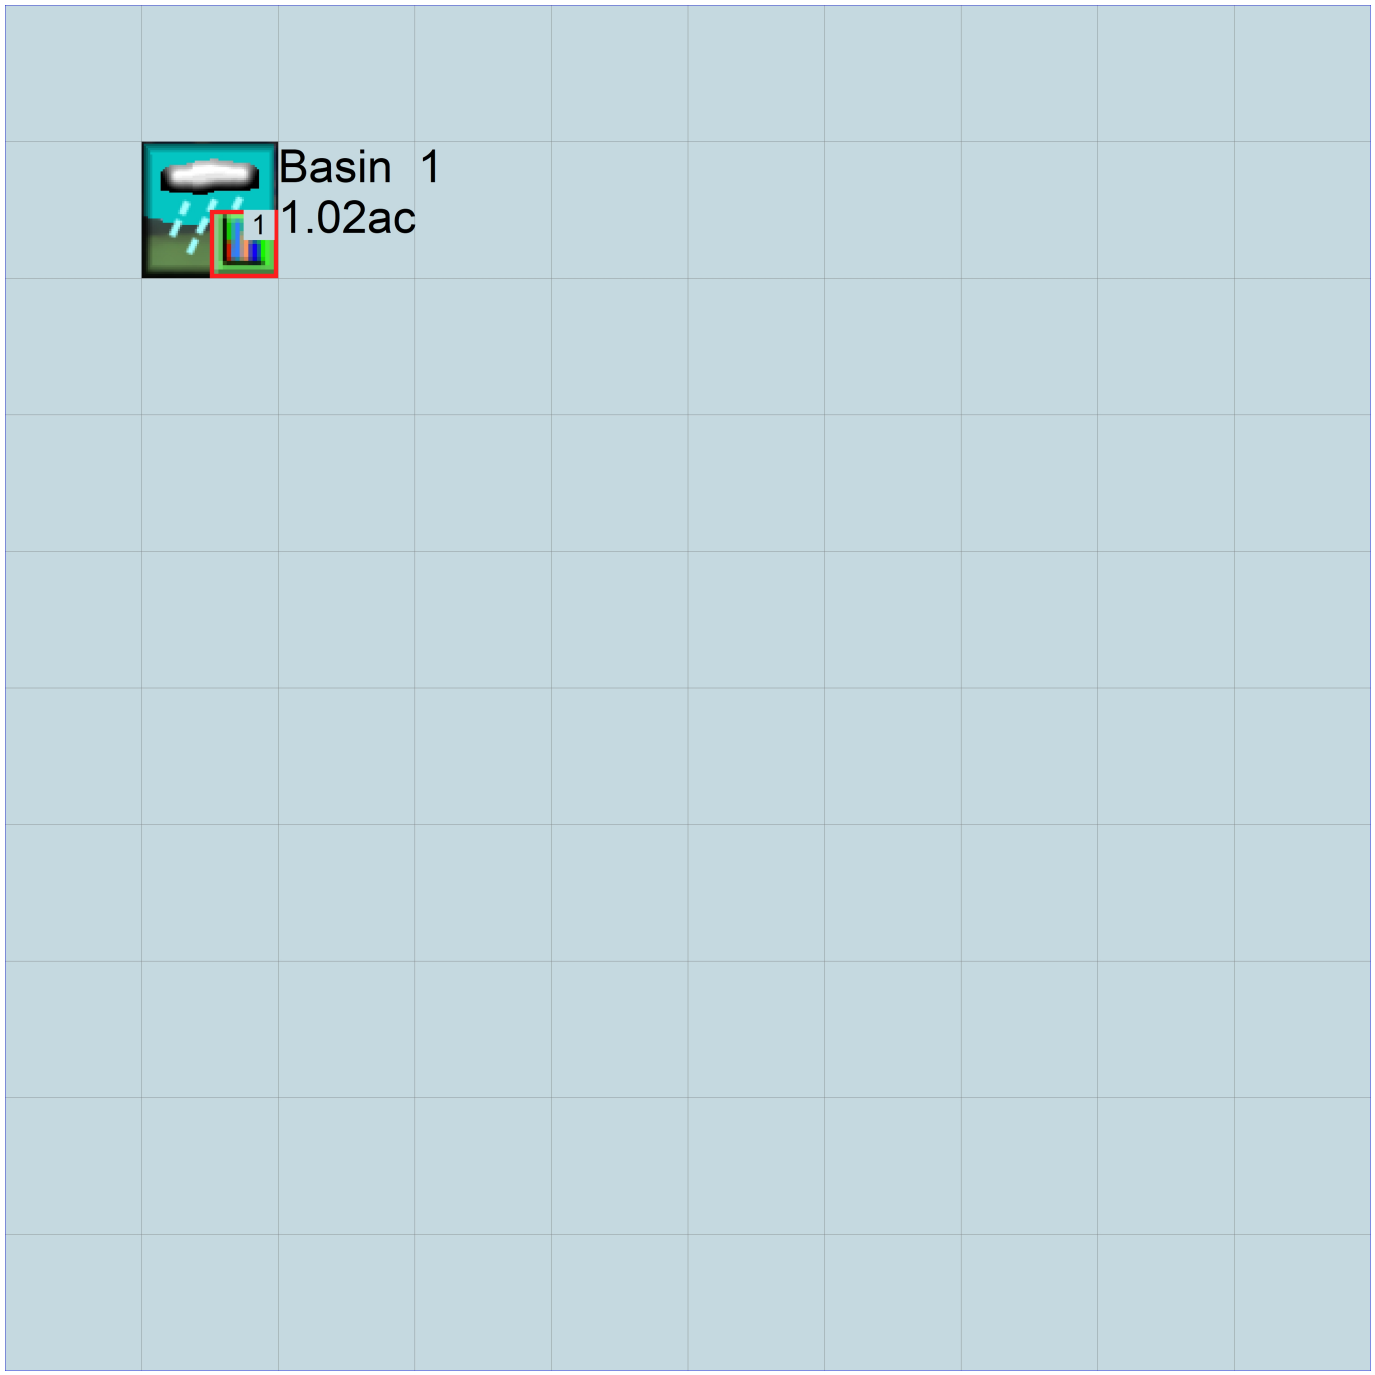

Mitigated Schematic



Disclaimer

Legal Notice

This program and accompanying documentation are provided 'as-is' without warranty of any kind. The entire risk regarding the performance and results of this program is assumed by End User. Clear Creek Solutions Inc. and the governmental licensee or sublicensees disclaim all warranties, either expressed or implied, including but not limited to implied warranties of program and accompanying documentation. In no event shall Clear Creek Solutions Inc. be liable for any damages whatsoever (including without limitation to damages for loss of business profits, loss of business information, business interruption, and the like) arising out of the use of, or inability to use this program even if Clear Creek Solutions Inc. or their authorized representatives have been advised of the possibility of such damages. Software Copyright © by : Clear Creek Solutions, Inc. 2005-2025; All Rights Reserved.

Clear Creek Solutions, Inc.
6200 Capitol Blvd. Ste F
Olympia, WA. 98501
Toll Free 1(866)943-0304
Local (360)943-0304

www.clearcreeksolutions.com

BARGHAUSEN

PRELIMINARY PUMP AND FORCE MAIN CALCULATIONS

FREEMAN LOGISTICS

PREPARED BY
JASON MCARDEL

PREPARED FOR	CLIENT ADDRESS
VECTOR DEVELOPMENT COMPANY	11411 NE 124TH ST, SUITE 190 KIRKLAND, WA 98034

SITE ADDRESS	PROJECT NO.	DATE	JURISDICTION
22ND AVE NW AND 82ND AVE E, PUYALLUP, WA	21585	07/14/2025	CITY OF PUYALLUP CITY OF FIFE

TABLE OF CONTENTS

1.0 INTRODUCTION/GENERAL INFORMATION

FIGURE 1 VICINITY MAP

APPENDICES

APPENDIX A Pump Designs

APPENDIX B Force Main Sizing

APPENDIX C Buoyancy Calculations

APPENDIX D Pump Details

APPENDIX E Operations and Maintenance Manual

1.0 INTRODUCTION/GENERAL INFORMATION

The following pages of this report delineate the criteria followed and the methodology used for sizing the storm pump and force main servicing the Freeman Logistics project.

The project includes 2 warehouse buildings with associated parking and frontage improvements totaling 26.30 acres of total disturbed area. Onsite, two separate detention vaults are proposed. The frontage improvement will be collected and detained separately with a separate detention vault. These detention facilities will detain and release stormwater in accordance with the Flow Control Standard per the Department of Ecology drainage manual (2019 Department of Ecology manual). The 100-year peak storm release rate of the vaults is 1.661 ft^3/sec. Released stormwater will then be treated for water quality using a DOE-approved proprietary structure. Following treatment, all flows, both onsite and offsite, will be conveyed to a manhole pump station. The pump station will convey flows northwest via a new 6-inch force main and then release further downstream, within an existing structure within the public road N. Levee Road E. The new force main will be approximately 4,146 feet in length.

Emergency standby power is proposed using a generator (natural gas or approved alternative). Additional storage volume is not required downstream of the detention vault.

This report also includes buoyancy calculations for the pump manhole due to the shallow seasonal high groundwater elevation on the site.

Figure 1
Vicinity Map



REFERENCE: MapQuest (2022)

Scale:
Horizontal: **N.T.S.** Vertical: **N/A**

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

For:
Freeman Road Logistics
Fife, Washington

Title:
VICINITY MAP

Job Number
21585

DATE: 09/01/22

P:\21000s\21585\exhibit\graphics\21585 vmap.cdr

Appendix A
Pump Design

STORM PUMP DESIGN

Pump Criteria:

- Design a submersible duplex pump with variable speed which can meet or exceed the 100-year peak release rate of the detention system.

  100-year peak release rate of combined facilities = 1.66 cfs = 744 gpm

- **Suggested pump size = dual 450 gpm at ±120-feet TDH**

Pump Cycles

- To meet the desired discharge characteristics for matching the flow control standard, the pump controls include a VFD (Variable Frequency Drive) and level sensor which allow a wide range of pump speed to match the outflow rate from the control structure on the vault. The pumps can be controlled down to a flow rate of approximately 90 gpm. Assuming the pump starts at the lowest speed, the cycle time would be:

  Wet well storage = Pump On - Pump Off x 118.96 gallons per linear feet of MH = 12.89 – 9.79 x 118.96 = 369 gallons

  Cycle time = 369 gal / 45 gpm = 8.2 minutes

  Cycles per hour = 7.3 cycles

Appendix B
Force Main Sizing

STORM FORCE MAIN DESIGN

Pump System

Force main design for proposed force main:

- Design flow in the force main = 450 gpm = 1.00 cfs

- Use 6-inch force main
  - Velocity = 1.0 cfs/0.196 sf = 5.12 fps
  - 5.12 fps < 8 fps OK

Static Head = Invert at downstream end of force main - Pump Off Elevation

Invert elevation at tie-in structure = 36.77

Pump off elevation = 9.79

Static Head = 36.77 – 9.79 = ±26.98 feet

Total Dynamic Head = based on pump configuration and force main (to be verified by pump manufacturer)

Force Main is HDPE (Sch. 40 Pipe)

New 6" Force Main Pipe Length = 4,146 feet

Friction loss in 6-inch main = 4,146/100 x 2.19 = 90.80 feet

Fitting losses in equivalent length of 6" straight pipe (From Friction Loss chart)

Elbows and valves: 90 deg = 15.2
45 deg = 8.1
Ball & check valve = 4

Head loss = (15.2+(2)(8.1)+4)/100 x 1 = 0.35 feet

Total Head = Static Head + Friction Loss = 26.98 + 90.8 feet + 0.35 feet = 118.13 feet

Pump System

Pump Station Control Panel Specification

Primary power shall be from the proposed recreational building. Contractor is to verify available power source and sizing prior to ordering the pump station. Each pump system shall have its own control panel.

The control panel for each sanitary pump station shall include:

- Control for a duplex pump system (controls to be hard wired)
- VFD control for each pump
- Enclosure for installation outside (installation to be near the pump station)
- Visual alarm – flashing light
- Display at control panel to monitor station performance
- 12-hour battery backup for control panel
- Manual and remote reset for alarms
- Alarms for:
    - Pump failure
    - Seal failure
    - High temperature
    - Low water
    - High water
    - Low battery
    - Power failure
- Duplex cycle counter
- Duplex elapsed run time meter
- Surge protection
- Dial up to 8 phone numbers during an alarm condition
- Minimum 1 year warranty

Table A.2 Friction Loss Data for PVC Pipe. Data courtesy IPEX Inc.

GPM	cu ft / sec	Velocity (ft/s)	Friction Head Loss (ft water / 100 ft)	Friction Pressure (psi / 100 ft)	Velocity (ft/s)	Friction Head Loss (ft water / 100 ft)	Friction Pressure (psi / 100 ft)	Velocity (ft/s)	Friction Head Loss (ft water / 100 ft)	Friction Pressure (psi / 100 ft)	Velocity (ft/s)	Friction Head Loss (ft water / 100 ft)	Friction Pressure (psi / 100 ft)
		1/2"											
1	0.002	1.13	1.16	0.50	3/4"								
2	0.004	2.26	4.19	1.81	1.26	1.03	0.44	1"			1 1/4"		
5	0.011	5.64	22.88	9.90	3.16	5.60	2.42	1.93	1.69	0.73	1.10	0.43	0.19
7	0.016	7.89	42.66	18.47	4.43	10.44	4.52	2.70	3.14	1.36	1.55	0.81	0.35
10	0.022				6.32	20.21	8.75	3.86	6.08	2.63	2.21	1.57	0.68
12	0.027				7.59	28.33	12.26	4.63	8.53	3.69	2.65	2.20	0.95
15	0.033				9.48	42.82	18.54	5.79	12.89	5.58	3.31	3.32	1.44
20	0.045							7.72	21.96	9.51	4.42	5.65	2.45
25	0.056							9.65	33.20	14.37	5.52	8.55	3.70
30	0.067							11.58	46.54	20.15	6.63	11.98	5.19
35	0.078										7.73	15.94	6.90
40	0.089	4"									8.84	20.41	8.84
45	0.100	1.15	0.13	0.06							9.94	25.39	10.99
50	0.111	1.28	0.16	0.07							11.05	30.86	13.36
55	0.123	1.41	0.19	0.08									
60	0.134	1.53	0.23	0.10									
65	0.145	1.66	0.26	0.11	5"								
70	0.156	1.79	0.30	0.13	1.14	0.10	0.04						
75	0.167	1.92	0.34	0.15	1.22	0.11	0.05						
80	0.178	2.05	0.39	0.17	1.30	0.13	0.06						
90	0.201	2.30	0.48	0.21	1.46	0.16	0.07	6"					
100	0.223	2.56	0.59	0.25	1.62	0.19	0.08	1.12	0.08	0.03			
125	0.279	3.20	0.89	0.38	2.03	0.29	0.13	1.40	0.12	0.05			
150	0.334	3.84	1.24	0.54	2.44	0.41	0.18	1.69	0.17	0.07			
175	0.390	4.47	1.65	0.72	2.84	0.55	0.24	1.97	0.22	0.10	8"		
200	0.446	5.11	2.12	0.92	3.25	0.70	0.30	2.25	0.29	0.12	1.30	0.08	0.03
250	0.557	6.39	3.20	1.39	4.06	1.06	0.46	2.81	0.43	0.19	1.62	0.11	0.05
300	0.668	7.67	4.49	1.94	4.87	1.49	0.64	3.37	0.61	0.26	1.94	0.16	0.07
350	0.780	8.95	5.97	2.58	5.69	1.98	0.86	3.93	0.81	0.35	2.27	0.21	0.09
400	0.891	10.23	7.64	3.31	6.50	2.54	1.10	4.49	1.03	0.45	2.59	0.27	0.12
450	1.003				7.31	3.15	1.36	5.06	1.29	0.56	2.92	0.34	0.15
500	1.114				8.12	3.83	1.66	5.62	1.56	0.68	3.24	0.41	0.18
600	1.337				9.75	5.37	2.33	6.74	2.19	0.95	3.89	0.57	0.25
700	1.560				11.37	7.15	3.09	7.87	2.92	1.26	4.54	0.76	0.33
800	1.782	18"						8.99	3.73	1.62	5.18	0.98	0.42
900	2.005	1.30	0.03	0.01				10.11	4.64	2.01	5.83	1.22	0.53
1000	2.228	1.45	0.04	0.02							6.48	1.48	0.64
1250	2.785	1.81	0.06	0.03	20"						8.10	2.24	0.97
1500	3.342	2.17	0.08	0.04	1.75	0.05	0.02				9.72	3.14	1.36
2000	4.456	2.89	0.14	0.06	2.33	0.08	0.04	24"					
2500	5.570	3.62	0.21	0.09	2.91	0.12	0.05	2.01	0.05	0.02			
3000	6.684	4.34	0.29	0.13	3.49	0.17	0.08	2.41	0.07	0.03			
3500	7.798	5.06	0.39	0.17	4.07	0.23	0.10	2.81	0.09	0.04			
4000	8.912	5.79	0.50	0.22	4.65	0.30	0.13	3.22	0.12	0.05			
4500	10.026	6.51	0.62	0.27	5.24	0.37	0.16	3.62	0.15	0.06			
5000	11.140	7.23	0.76	0.33	5.82	0.45	0.19	4.02	0.18	0.08			
5500	12.254	7.96	0.91	0.39	6.40	0.53	0.23	4.42	0.22	0.09			
6000	13.368	8.68	1.06	0.46	6.98	0.63	0.27	4.83	0.25	0.11			
6500	14.482	9.40	1.23	0.53	7.56	0.73	0.31	5.23	0.30	0.13			
7000	15.596	10.13	1.42	0.61	8.14	0.83	0.36	5.63	0.34	0.15			
7500	16.710				8.73	0.95	0.41	6.03	0.39	0.17			
8000	17.824				9.31	1.07	0.46	6.43	0.43	0.19			
8500	18.938				9.89	1.19	0.52	6.84	0.49	0.21			
9000	20.052				10.47	1.33	0.57	7.24	0.54	0.23			
9500	21.166							7.64	0.60	0.26			
10000	22.280							8.04	0.66	0.28			

10.1002/9780470168103.app1, Downloaded from https://onlinelibrary.wiley.com/doi/10.1002/9780470168103.app1, Wiley Online Library on [26/05/2023]. See the Terms and Conditions (https://onlinelibrary.wiley.com/terms-and-conditions) on Wiley Online Library for rules of use; OA articles are governed by the applicable Creative Commons License

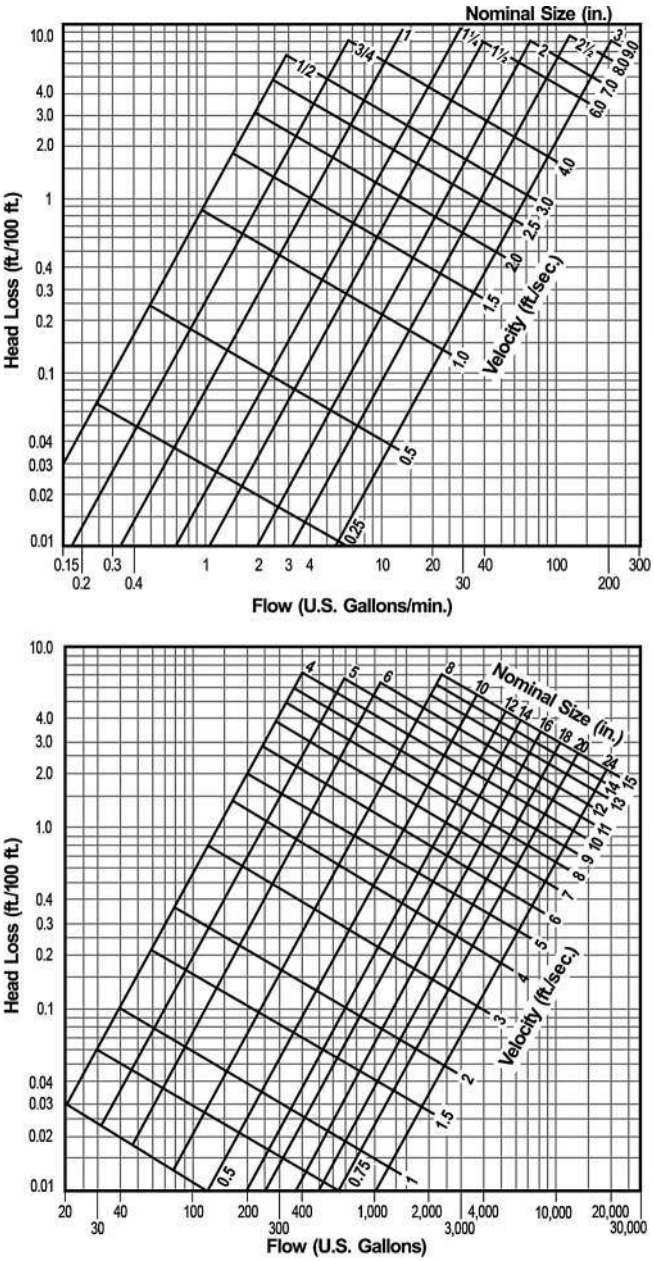


Figure A.1 Graphical depiction of friction loss through PVC pipe. Data courtesy IPEX Inc.

Table A.3 Friction Loss Through Fittings in Equivalent Footage of Pipe. Data Courtesy IPEX Inc.

	FITTINGS			
Size (in.)	Tee Run	Tee Branch	90° Elbow	45° Elbow
½	1.0	3.8	1.5	0.8
¾	1.4	4.9	2.0	1.1
1	1.7	6.0	2.5	1.4
1 ¼	2.3	7.3	3.8	1.8
1 ½	2.7	8.4	4.0	2.1
2	4.0	12.0	5.7	2.6
2 ½	4.9	14.7	6.9	3.1
3	6.1	16.4	7.9	4.0
4	7.9	22.0	11.4	5.1
6	12.3	32.7	16.7	8.0
8	14.0	49.0	21.0	10.6
10	17.5	57.0	26.0	13.5
12	20.0	67.0	32.0	15.5
14	25.0	78.0	37.0	18.0
16	27.0	88.0	43.0	20.0
18	32.0	107.0	53.0	23.0
20	35.0	118.0	58.0	25.0
24	42.0	137.0	67.0	30.0

10.1002/9780470168103.app1, Downloaded from https://onlinelibrary.wiley.com/doi/10.1002/9780470168103.app1, Wiley Online Library on [26/05/2023]. See the Terms and Conditions (https://onlinelibrary.wiley.com/terms-and-conditions) on Wiley Online Library for rules of use; OA articles are governed by the applicable Creative Commons License

Appendix C
Buoyancy Calculations

FREEMAN STORM BUOYANCY CALCULATIONS

- **SD Pump Manhole, Type 2 - 54 inches**
  Rim: 33.15
  Inside Bottom = 6.79
  Outside Bottom = 6.12

- **Weight of Manhole**

  Top Slab = ~2,600 lbs
  Barrell = 1,100 lb/lf x (33.15 -0.67- 11.12) = 23,496 lbs
  Bottom 5' base = 7,600 lbs
  Total (manhole) = 33,696 lbs
  $P_{Manhole}$ = 33.7 Kip↓

- **Water Weight**

  Max groundwater height (~5' bge) = 28.15 feet
  Manhole displacement = (28.15 – 6.12) x π r^2 = 22.03 π $(2.625)^2$ = 476.65 CF
  Water unit weight = 62.4 lb/ft^3
  P_{Water} = 476.65 x 62.4 = 29,743.18 lb = 29.8 Kip↑

- **Buoyancy**

  $\sum_F = P_{Manhole} - P_{Buoyancy}$ = 33.7K↓ - 29.8K↑ = 3.9 K↓


  $FS = \frac{33.7}{29.8}$ = 1.13

PRELIMINARY STORM PUMP DETAILS

OF


FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

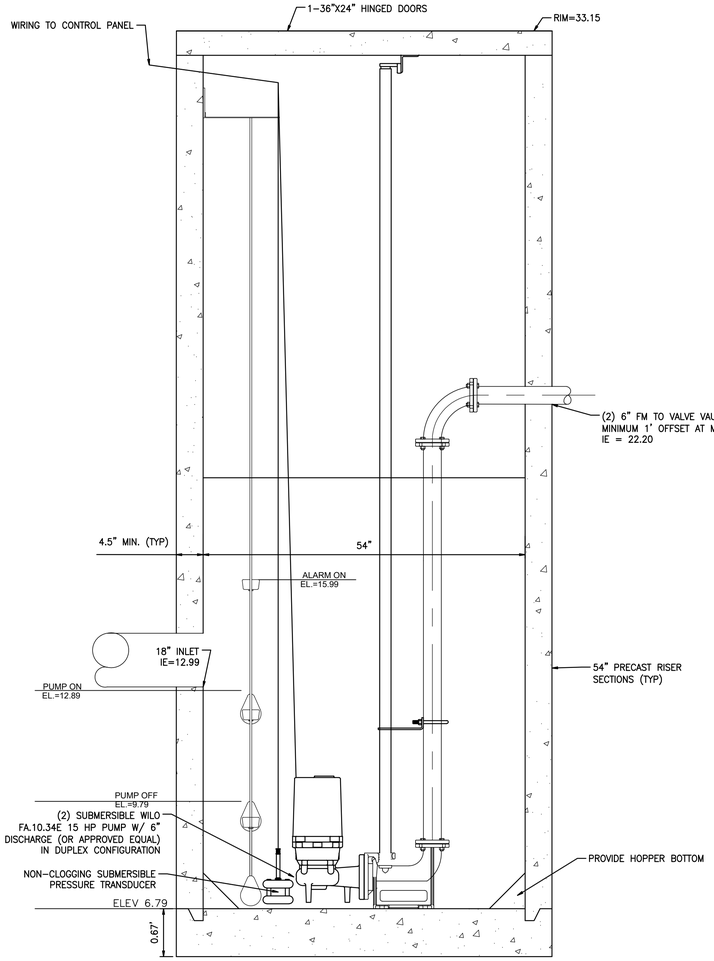


STORM PUMP MANHOLE DETAIL


SCALE: HOR. 1"=2' VER. 1"=1'

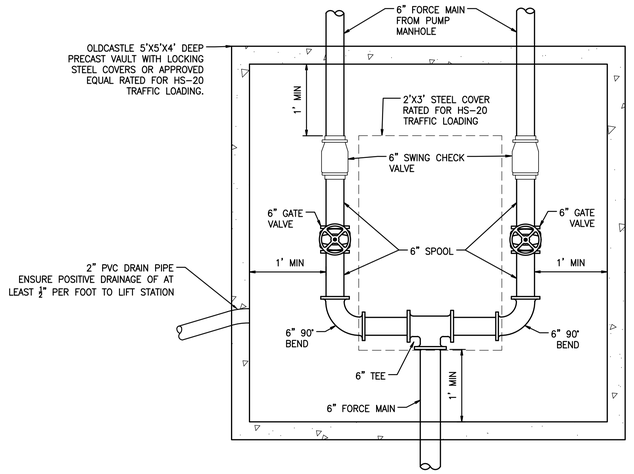

STORM VALVE VAULT DETAIL

SCALE: NTS

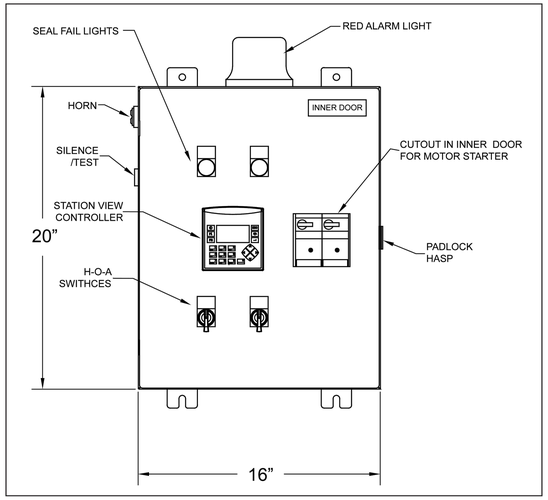

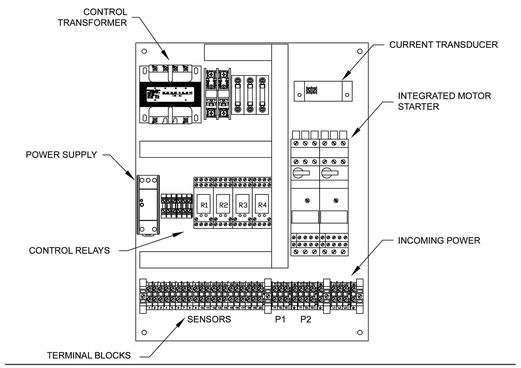

EXAMPLE THREE PHASE DUPLEX LIFT STATION CONTROL PANEL

SCALE: NTS

NOTES:


1. EMERGENCY BACKUP GENERATOR TO BE PROVIDED BY CONTRACTOR. SIZING TO BE DETERMINED BASED ON FINAL PUMP SELECTION. GENERATOR TO BE SIZED TO ACCOMMODATE BOTH PUMPS OPERATING. CONTROL PANEL TO BE EQUIPPED WITH AUTOMATIC TRANSFER SWITCH. SEE SITE PLAN FOR SUGGESTED GENERATOR LOCATION.
2. CONTROL PANEL TO BE EQUIPPED WITH VARIABLE FREQUENCY DRIVES (VFD) FOR BOTH PUMPS.

Wilo Quick Ship
Equipment Submittal

wilo®

FA 10.34E – 4 pole, 1740 RPM, Non-clog Vane Type



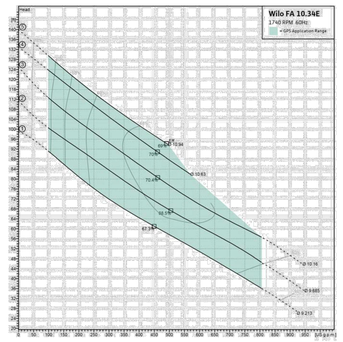

Installation Type	
Installation Type	Wet Pit
	Dry Pit
Voltage	230v
	460v
Suction Size	4"
Discharge Size	4"

Impeller Number	Impeller Diameter		Motor HP
	in	mm	
1	9.213	234	15.5
2	9.685	246	15.5
3	10.16	258	25
4	10.63	270	25
5	10.94	278	25

Materials of Construction	
Volute	ASTM A48 Class 35 Cast Iron
Impeller	ASTM A48 Class 35 Cast Iron
Volute Wear Ring	AISI 304 Stainless Steel
Impeller Wear Ring	AISI 329 Duplex Stainless Steel

WILO USA LLC
86 Genesis Parkway
Thomasville, GA 31792

T + 888-945-6872
F + 888-945-6873
www.wilo-usa.com

STORM PUMP CURVE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
6	05/27/25	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY STORM PUMP DETAILS**
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MORRELL — STATE OF WASHINGTON — 54927 — REGISTERED PROFESSIONAL ENGINEER
5/29/25

Scale: Horizontal AS SHOWN Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 5/29/25

Barghausen Consulting Engineers, LLC.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com


Job Number 21585

Sheet C43 of 48

P:\21000s\21585\engineering\SEPA SET\21585-D.dwg 5/28/2025 1:01 PM DCASEY


RUNOFF TREATMENT BMP SELECTION FLOW CHART

Figure III-1.1: Runoff Treatment BMP Selection Flow Chart

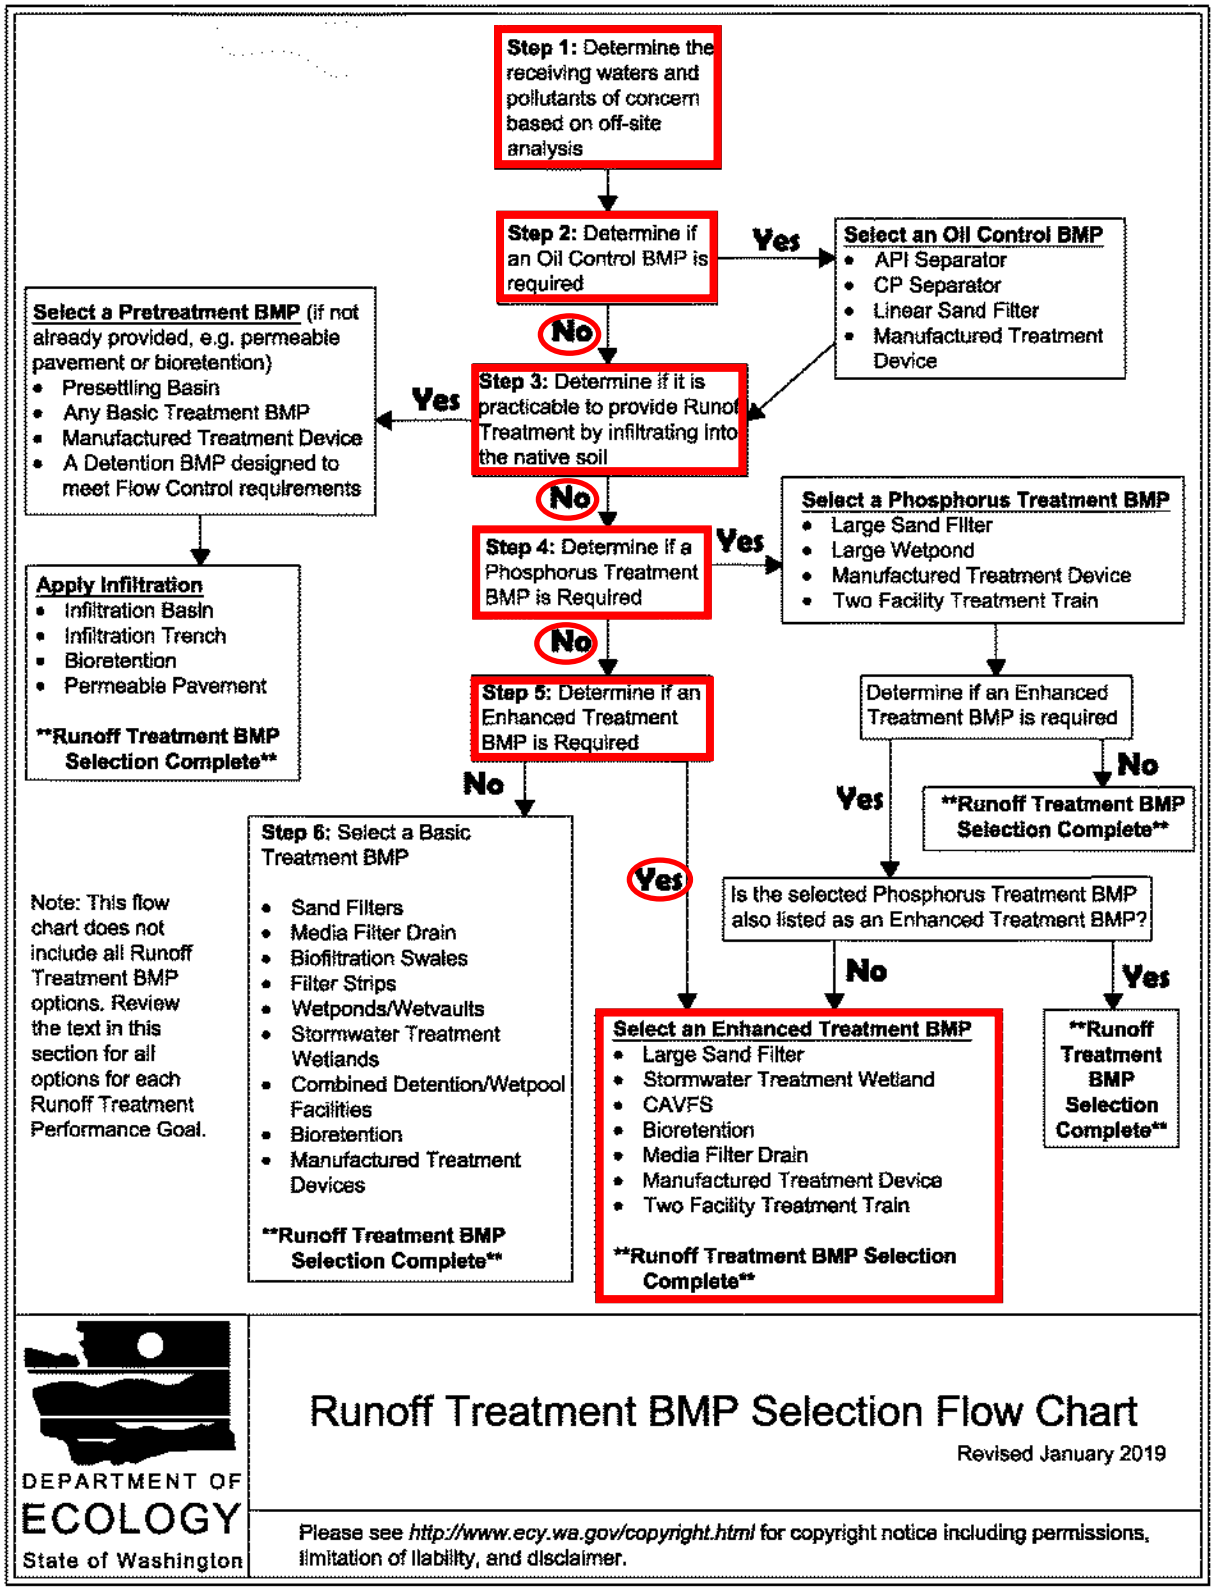

OFFSITE

Figure III-1.1: Runoff Treatment BMP Selection Flow Chart

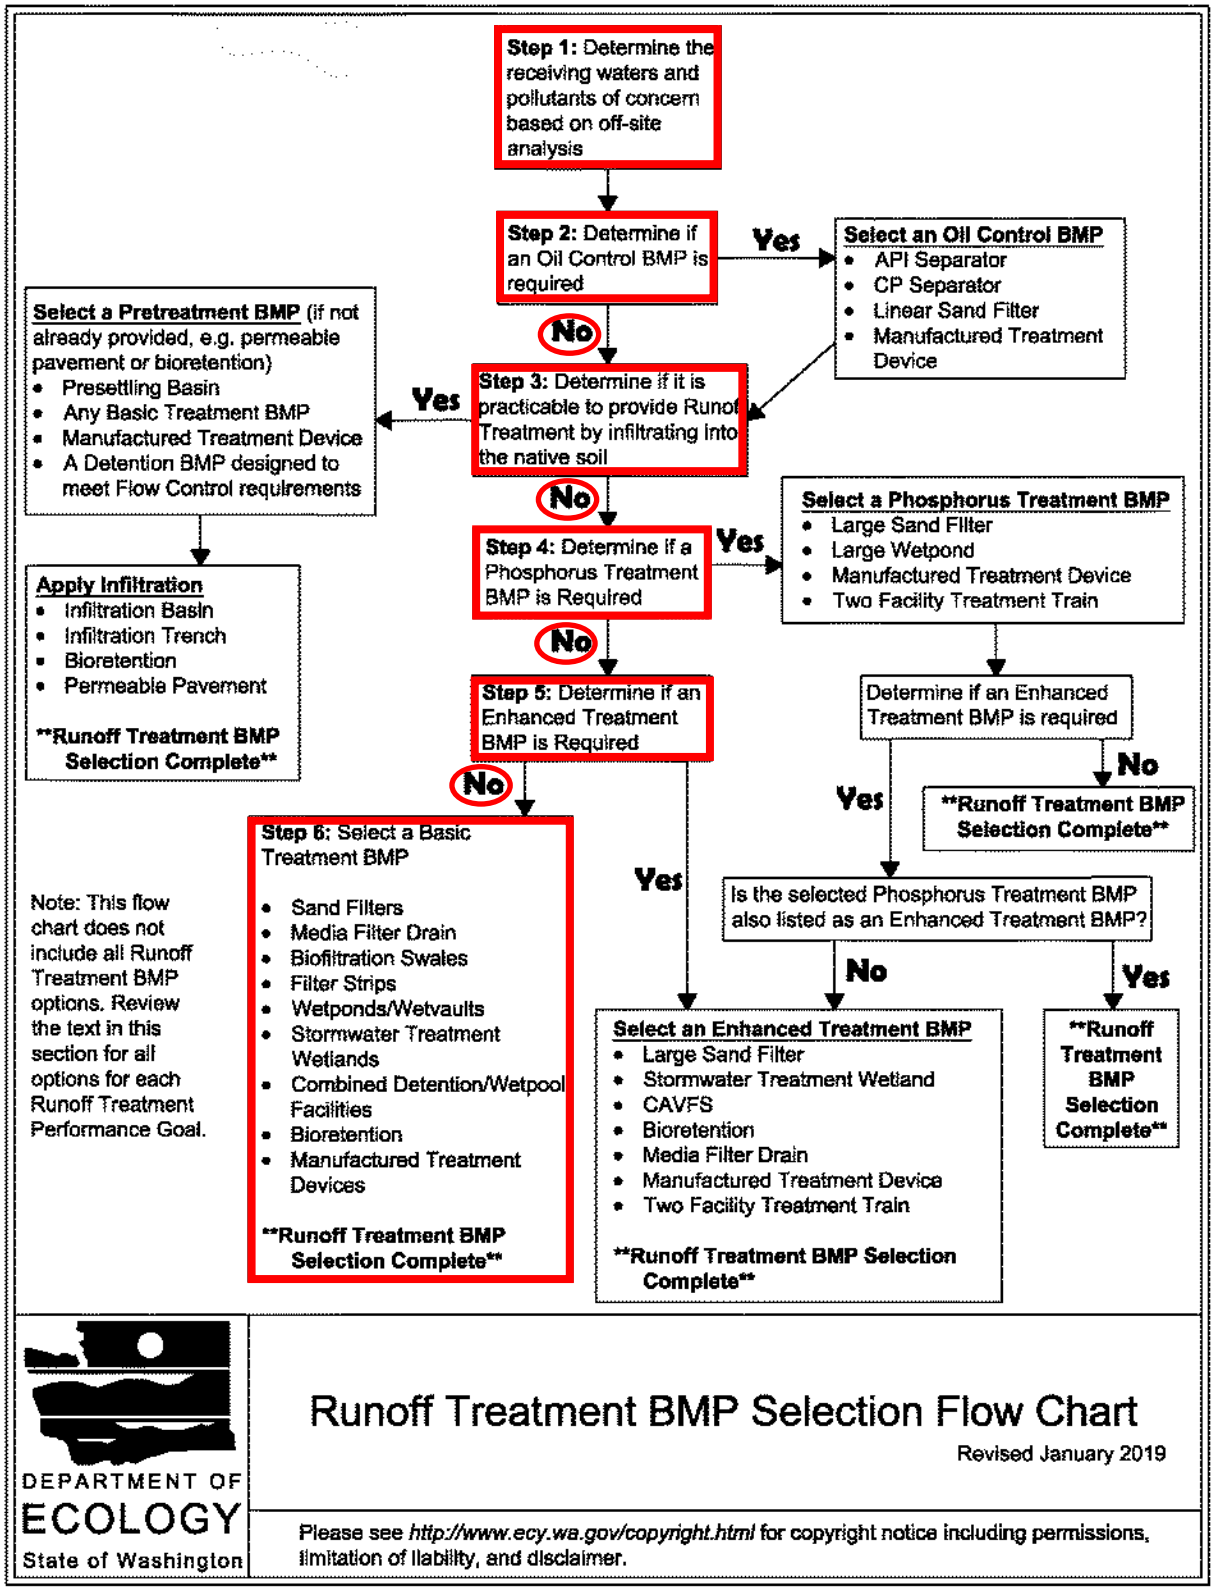

Tab 6.0

6.0 SPECIAL REPORTS AND STUDIES



December 2024
Freeman Road Logistics

ANCHOR QEA

Critical Areas Report

Prepared for Vector Development Company

December 2024
Freeman Road Logistics

Critical Areas Report

Prepared for
Vector Development Company
11411 NE 124th Street
Kirkland, Washington 98034

Prepared by
Anchor QEA
1201 3rd Avenue, Suite 2600
Seattle, Washington 98101

Project Number: 212141-02.01

TABLE OF CONTENTS

1 Introduction 1

1.1 Review of Existing Information 2

1.2 Qualifications 2

2 Project Purpose and Need 4

2.1 Project Purpose 4

2.2 Project Need 4

3 Study Area Description 6

3.1 Soils 6

3.2 Hydrology 8

3.3 Plant Communities 8

4 Critical Areas Assessment 10

4.1 Methods 10

4.2 Wetlands 10

4.2.1 Main Development Area 10

4.2.2 Transportation and Utility Parcels 0420201008, 0420201114 and 0420201115 11

4.2.3 Transportation and Utility Parcel 0420201104 13

4.2.4 Transportation and Utility Parcel 0420174032 13

4.2.5 WSDOT-Owned Parcels 0420178009, 0420201110, 0420201111, 0420174028, and 0420174054 13

4.3 Streams 14

4.4 Fish and Wildlife Habitat Conservation Areas 14

4.4.1 Streams 15

4.4.2 Vegetation 15

4.4.3 Wildlife and Habitat 16

4.4.4 Priority Species and Habitats 16

4.5 Special Flood Hazard Areas 18

5 Wetland Delineation 19

5.1 Methodology 19

5.1.1 Vegetation 20

5.1.2 Soils 21

5.1.3 Hydrology 21

5.1.4 Wetland Community Types 21

5.1.5 Wetland Ratings 22
5.1.6 Wetlands Function Assessment 22
5.1.7 State Hydrogeomorphic Classification System 23
5.2 Results 23
5.2.1 Wetland A 24
5.2.2 Wetland B 26
5.2.3 WSDOT-Owned Parcel Wetlands 28
5.3 Puyallup Wetland Buffer Guidance 29
6 Critical Areas Impact Assessment 31
6.1 On-Site and Off-Site Wetland Impacts 32
6.1.1 On-Site Wetland B Impacts 32
6.1.2 Off-Site Wetland A 32
6.1.3 Off-Site Freeman Road East Widening Adjacent to Parcels 0420201104 and 0420201008 32
6.1.4 Off-Site Road-Widening Adjacent to Parcel 0420174032 33
6.1.5 Off-Site Wetland 87 and Wetland 146/148 Buffer Impacts 33
6.1.6 Off-Site Wetland 89 Impact 34
6.1.7 Off-Site Parcels Considered During Design Analysis 34
6.2 On-Site Stream Buffer 34
6.3 Special Flood Hazard Areas Habitat Assessment 35
7 Site Selection Screening and Alternatives Analysis 38
7.1 Site Selection Screening Criteria 38
7.2 Achievement of Project Purpose and Need 39
7.3 Avoidance and Minimization of Impacts 39
7.4 Practicability 40
7.4.1 General Practicability Criteria: 40
7.4.2 Site-Specific Practicability Criteria 40
7.5 Alternatives Analysis 41
7.5.1 Alternative 1: No Action 41
7.5.2 Alternative 2: Off-Site Alternatives 41
7.5.3 Alternative 3: North-South Building Layout No 1 41
7.5.4 Alternative 4: North-South Building Layout No 2 42
7.6 Site Selection Screening and Alternatives Analysis Conclusions 43

8 Avoidance, Minimization, and Mitigation Measures 44
8.1 Mitigation Sequencing 44
8.2 Avoidance and Minimization Measures 45
8.2.1 Design Measures 45
8.2.2 Construction Measures and Best Management Practices 45
8.3 General Goals of Compensatory Mitigation 46
8.4 Compensatory Mitigation 46
8.4.1 Wetlands and Critical Area Buffers 46
8.4.2 Functional Benefits of the Mitigation 49

9 Proposed On-Site Mitigation Planting Plan 52
9.1 General Description of On-Site Mitigation Planting 52
9.2 Soil Preparation 52
9.3 Vegetation 52
9.4 Construction and Planting Schedules 53
9.5 General Mitigation Goals 53
9.6 Objectives and Standards of Success for Wetland Mitigation 53
9.7 Monitoring Plan 53
9.8 Contingency Plan 54
9.9 Mitigation Site Management 54

10 References 56

TABLES

Table 1 Soils Mapped Within the Study Area by the NRCS Web Soil Survey 7
Table 2 Federally Listed Species That May Occur in Study Area 17
Table 3 Wetland Plant Indicator Status Definitions 20
Table 4 Wetlands Delineated by Anchor QEA Within the Study Area 23
Table 5 Summary of Scores for Wetland Functions and Values 24
Table 6 Off-Site WSDOT Wetlands 28
Table 7 Summary of Scores for WSDOT Wetland Functions and Values 28
Table 8 Proposed Wetland Buffer Widths 30
Table 9 Proposed Freeman Road Logistics Project Wetland Impacts 31
Table 10 Summary of Anticipated of Critical Area Impacts and Mitigation Actions 47
Table 11 Proposed Mitigation Debit Ratios in Use at Mitigation Bank 48

Table 12 Scenario 2 (0.2:1 Ratio): Critical Area Impacts and Proposed Credit Purchase..... 48

FIGURES

Figure 1 Vicinity Map
Figure 2 Study Area and Existing Conditions
Figure 3 NRCS Soils Map
Figure 4 Pierce County Wetlands Inventory Map
Figure 5 USFWS National Wetlands Inventory Map
Figure 6 Off-Site WSDOT Parcels Critical Areas and Buffers
Figure 7 Wetland Delineation Results
Figure 8 Proposed Development and Critical Areas
Figure 9 Conceptual Mitigation Plan

APPENDICES

Appendix A Site Plan and Construction Details
Appendix B Study Area Photographs
Appendix C Wetland Forms and Figures
Appendix D WSDOT State Route 167 Completion Project Mitigation Excerpts
Appendix E On-Site Mitigation Design Plans

ABBREVIATIONS

2010 Regional Supplement	*Regional Supplement to the Corps of Engineers Wetland Delineation Manual: Western Mountains, Valleys, and Coast Region*
BFE	base flood elevation
BMP	best management practice
CAR	*Critical Areas Report*
CY	cubic yard
DP	data plot
EC	Employment Center zoning designation
Ecology	Washington State Department of Ecology
ESA	Endangered Species Act
FAC	facultative
FACU	facultative upland
FACW	facultative wetland
FEMA	Federal Emergency Management Agency
FMC	Fife Municipal Code
FRO	Freeman Road Overlay
HGM	hydrogeomorphic
I-5	Interstate 5
LM/W	Light Manufacturing/Warehousing zoning designation
Mitigation Bank	Port Tacoma Upper Clear Creek Mitigation Bank
NAVD88	North American Vertical Datum of 1988
NMFS	National Marine Fisheries Service
NRCS	National Resources Conservation Service
NWI	National Wetlands Inventory
NWSA	Northwest Seaport Alliance
OBL	obligate wetland
OHWM	ordinary high water mark
PEM	palustrine emergent
PFO	palustrine forested
PHS	Priority Habitats and Species
PMC	Puyallup Municipal Code
Port	Port of Tacoma
Project	Freeman Road Logistics project
PSS	palustrine scrub-shrub
redox	redoximorphic
Third-Party Review Report	Third-Party Review of Critical Areas Report

Third-Party Second Review Report	Third-Party Second Review of Critical Areas Report
Third-Party Third Review Report	Third-Party Third Review of Critical Areas Report
UPL	obligate upland
USACE	U.S. Army Corps of Engineers
USFWS	U.S. Fish and Wildlife Service
Washington rating system	*Washington State Wetland Rating System for Western Washington: 2014 Update*
WDFW	Washington Department of Fish and Wildlife
WSDOT	Washington State Department of Transportation

1 Introduction

Vector Development Company is proposing construction of two new warehouse buildings as part of the Freeman Road Logistics Project (Project), east of Freeman Road East and west of the future Washington State Department of Transportation (WSDOT) State Route 167 Completion Project. The Project includes redevelopment of 15 adjacent parcels, henceforth referred to as the Main Development Area (parcels 0420174075, 0420201040, 0420201039, 0420201045, 0420201066, 0420201101, 0420205003, 0420205017, 0420201027, 0420201052, 0420201034, 0420201036, 0420201042, 0420205004, 0420205016) in Puyallup, Washington. Utilities routing to and from the Main Development Area will be routed through existing right of ways for Freeman Road East and North Levee Road East. Eight other parcels (0420201008, 0420201104, 0420201114, 0420201115, and 0420212073), as well as Freeman Road East and North Levee Road, will support the development through transportation or utility improvements, henceforth referred to as the Transportation and Utility parcels. A vicinity map is shown in Figure 1, and an aerial photograph of existing conditions at the Study Area, which includes the WSDOT-owned parcels and Transportation and Utility parcels is shown in Figure 2.

The proposed development would include two warehouses, associated utilities, vehicle and truck parking and maneuvering space, widening of access roads, stormwater management, landscaping, and improvements along Freeman Road East (Appendix A). The Project has been designed to be consistent with local regulations, including the City of Fife and City of Puyallup Shoreline Master Plans.

This *Critical Areas Report* (CAR) has been prepared by Anchor QEA scientists to support the local permitting and land use review of the Project. The CAR evaluates the presence of critical areas within the Main Development Area, Transportation and Utility parcels, and WSDOT-owned parcels and addresses potential impacts to existing critical areas and associated regulated buffers, as defined in the City of Puyallup Municipal Code (PMC) Chapter 21 (City of Puyallup 2024a). The format of this CAR has been prepared consistent with PMC 21.06. Critical areas regulated under PMC Chapter 21 include wetlands, streams, fish and wildlife habitat conservation areas, frequently flooded areas, and minor lakes.

Additionally, the CAR evaluates the presence of critical areas within the Transportation and Utility parcels and roadways and addresses potential impacts to existing critical areas and associated regulated buffers, as defined in the City of Fife Municipal Code (FMC) Chapter 17 (City of Fife 2024a). The format of this CAR has been prepared consistent with FMC 17.05. Critical Areas regulated under FMC Chapter 17 include wetlands and wildlife habitat conservation areas.

Anchor QEA scientists gathered and reviewed existing information consistent with PMC Chapter 21 and FMC Chapter 17 to identify and assess existing critical areas. To support this review, Anchor QEA

biologists performed critical areas site visits to the Study Area on April 1 and September 28, 2021; March 11, 2022; March 23, 2023; May 19, 2023; April 12, 2024; and May 17, 2024. The information provided in this CAR has been prepared by professional biologists using the best available science to provide an accurate evaluation of critical areas and potential impacts.

1.1 Review of Existing Information

As part of the analysis to identify critical areas, Anchor QEA biologists reviewed the following sources of information to support field observations:

- PMC (City of Puyallup 2024a)
- City of Puyallup GIS Portal Wetland and Stream Maps (City of Puyallup 2024b)
- FMC (City of Fife 2024a)
- City of Fife Wetlands Map (City of Fife 2024b)
- Pierce County PublicGIS Interactive Mapping Tool (Pierce County 2024)
- U.S. Department of Agriculture Natural Resources Conservation Service Web Soil Survey (USDA 2024)
- National Marine Fisheries Service (NMFS) Endangered Species Act (ESA) status reviews and listing information (NMFS 2024)
- U.S. Fish and Wildlife Service (USFWS) National Wetlands Inventory (NWI) Wetlands Mapper (USFWS 2024a)
- USFWS ESA Status Reviews and Listing Information (USFWS 2024b)
- Washington Department of Fish and Wildlife (WDFW) Priority Habitats and Species (PHS) Maps (WDFW 2024a)
- WDFW SalmonScape Mapping System (WDFW 2024b)
- Publicly available aerial photographs
- Third-Party Review of Critical Areas Report (Third-Party Review Report), Third-Party Second Review of Critical Areas Report (Third-Party Second Review Report), and Third-Party Third Review of Critical Areas Report (Third-Party Third Review Report) produced by Confluence Environmental Group (2022, 2024a, 2024b)

1.2 Qualifications

This CAR was prepared following site visits conducted by Anchor QEA on the following dates:

- April 1, 2021
- September 28, 2021
- March 11, 2022
- March 23, 2023
- May 19, 2023
- April 12, 2024

- May 17, 2024

Personnel who contributed to the surveys and preparation of this CAR are listed as follows:

- Laura Caron: Former Anchor QEA Natural Resource Scientist now working as a Fisheries and Wetlands Biologist at WSDOT. Responsible for 2021 and 2022 field investigations and reporting; BA Environmental Studies and Geology, University of Colorado; MNRS Natural Resource Management and Ecological Restoration, Colorado State University; Certified Wetland Delineator, U.S. Army Corps of Engineers (USACE); Certified Wetland Rater, Washington State Department of Ecology (Ecology); Qualified Junior Author for Biological Assessment, WSDOT, through 2028; Qualified Biologist for Preliminary Hydraulic Stream Design and Restoration, WSDOT.
- Calvin Douglas: Former Anchor QEA Wetland Scientist, now working as a Senior Ecologist at Confluence Environmental Group. Responsible for 2021 and 2022 field investigations and reporting; BS Wildlife Biology, University of Washington; Pierce County Certified Wetland Scientist and Wildlife Biologist; Qualified Senior Writer for Biological Assessment, WSDOT, through 2024.
- Hannah Fotherby: Anchor QEA Wetland Biologist supporting 2023 and 2024 field investigation and reporting; BA Environmental Studies, University of Washington; MEH Restoration Ecology and Environmental Horticulture, University of Washington; Pierce County Certified Wetland Scientist.
- Jakob Rowny, PWS: Anchor QEA Senior Wetland Biologist and Environmental Scientist responsible for 2023 and 2024 field investigations and reporting; BS Ecology and Evolutionary Biology, University of California; MS Environmental Sciences and Engineering, University of North Carolina; Pierce County Certified Wetland Scientist; 10 years of wetland delineation, categorization, and critical area assessment and reporting experience in Washington State and Oregon.
- Josh Jensen: Anchor QEA Senior Managing Planner responsible for field oversight and code compliance; BS Economics and Environmental Studies, Western Washington University; MEM, Duke University.
- Dan Berlin, PWS: Anchor QEA Principal Scientist responsible for directing and reviewing all field work and documentation; BA Biology, Kalamazoo College; MEM Wetland Science, Duke University.

2 Project Purpose and Need

2.1 Project Purpose

The overall purpose of the Project is to provide 500,000 square feet of warehouse capacity and logistical support for receiving and distribution. The Project is intended to use existing and planned transportation infrastructure, including the WSDOT State Route 167 Completion Project, a portion of which is located just east of the Main Development Area, and includes construction of 4 miles of new highway between Meridian Avenue and Interstate 5 (I-5) and several new interchanges. The State Route 167 Completion Project will provide east-west linkages between the Port of Tacoma (Port) and manufacturing and industrial areas in Pierce County and will improve overall regional mobility by reducing congestion on surrounding local roads and highways.

The Project is also intended to use the nearby Pierce County Canyon Road Regional Connection Project that will extend Canyon Road East from Pioneer Way East to 70th Avenue East in Fife by constructing a new bridge across the Puyallup River. This Project will also improve regional mobility by providing freight haulers and other traffic faster, safer, and more direct access to State Route 167, I-5, and Port facilities.

The Project is situated in an area that was recently rezoned to support the planned receiving and distribution use by the City of Puyallup, as documented in the Freeman Road Comprehensive Plan Map Amendment, Case Number L-20-0001, and the Freeman Road Overlay (FRO), which was adopted by City of Puyallup Ordinance No 3278, passed June 27, 2023. The Freeman Road Comprehensive Plan Map Amendment and FRO annexed and provided Light Manufacturing/Warehousing (LM/W) zoning for 11 previously unincorporated parcels east of Freeman Road East and west of the WSDOT State Route 167 Completion Project. The proposed Project layout satisfies City of Puyallup requirements and achieves the applicant's purpose of providing additional warehouse capacity and logistical support in an area zoned for those uses and will be consistent with current and anticipated future land uses of the surrounding areas.

In the context of Pierce County and WSDOT projects—and the City of Puyallup's goals of bolstering a vibrant local economy by supporting land supply for business opportunities, and providing a safe, livable, and healthy community—the Project purpose provides an appropriate land use solution. The Project will create safer neighborhoods by separating truck activity away from residential uses, support the local economy by providing well-paying jobs, and protect and enhance environmental functions and values as part of the Project.

2.2 Project Need

The overall need of the Project is to address an existing shortage of receiving and distribution facilities east of Tacoma, which is expected to be more significant considering projected growth in

the region and associated shipping though the Port and other regional ports. The Northwest Seaport Alliance (NWSA), which includes Port shipping activities, is one of the largest marine cargo gateways in the United States. More than 3.7 million 20-foot equivalent units carrying 26.1 million metric tons of containerized cargo were handled at NWSA facilities (NWSA 2019). Shipping at the Port is anticipated to increase above pre-pandemic tonnages and will continue to be a primary driver of the regional economy (Pierce County 2023). To support this growing demand for shipping and distribution, USACE, and NWSA plan to deepen the Port's Blair Waterway, which will allow extra-large container ships access to the Port. The Port is also planning future redevelopment to support economic growth, job creation, and trade, including several cleanup projects, completion of habitat and wetland mitigation bank projects, and ongoing maintenance and improvements to stormwater systems and Port-specific infrastructure such as dock, pier, and fender system upgrades (Port 2023).

The Freeman Road Logistics Project is designed to provide needed warehouse capacity and logistical receiving and distribution support in an area that is regionally important to continued economic growth and resiliency. The rezone of the properties within the Main Development Area acknowledges the need for more warehouse and logistical projects within the City of Puyallup, as described in the City of Puyallup's Freeman Road Comprehensive Plan Map Amendment and FRO. The design elements and standards included in the Freeman Road Comprehensive Plan Map Amendment and FRO were developed through a multiyear, multi-stakeholder planning process to achieve appropriate land use zoning for the area, provide high-quality amenities, support regional transportation, water, sewer, and stormwater infrastructure, and include reasonable setbacks for the neighborhood residents to retain the aesthetic character of the area and improve the safety of residents and visitors.

While meeting the specific purpose and need of the Project by supplying improved warehousing capacity and logistical support in the area, the Project is expected to result in no net loss of ecological function to the critical areas evaluated in this report. The Project will comply with federal, state, and local regulations that require mitigation for unavoidable net adverse impacts to fish and wildlife species that rely on highly functioning shoreline, stream, and wetland areas.

3 Study Area Description

The Study Area of this CAR encompasses 154.33 acres and is composed of the following sections (Figure 2):

- The Main Development Area, which is made up of the 15 adjacent parcels where the Project is located and encompasses 24.04 acres
- The Transportation and Utility parcels, which are eight parcels in total, with four in the City of Puyallup and four in the City of Fife. The four parcels in the City of Puyallup are located south of the Main Development Area and include three undeveloped parcels (parcels 0420201008, 0420201114, and 0420201115) and the O'Reily-owned parcel 040212073. The four parcels in the City of Fife include the two parcels located immediately west of the Main Development Area and Freeman Road East (parcels 0420201104 and 0420174032), and the two parcels north of 48th Street East. In total, the Transportation and Utility parcels encompass 105.26 acres. This area also includes portions of 48th Street East and 78th Avenue East in the City of Fife
- The five WSDOT-owned parcels located north and east of the Main Development Area (parcels 0420201110, 0420201111, 0420174028, 0420174054, and 0420178009) that encompass 25.03 acres

The Main Development Area is currently developed for residential and agricultural uses and consists of open lawn areas, residential housing, agricultural fields, and paved and gravel roadways. Many of the residential buildings were demolished and removed prior to Anchor QEA's May 2023 site visit. An agricultural drainage ditch is located off site on WSDOT properties, adjacent to the undeveloped northeast corner of the Main Development Area. The west boundary of the Main Development Area is bounded by Freeman Road East. Photographs of the Study Area are included in Appendix B. One wetland, Wetland A, was identified off site to the south and one wetland, Wetland B, was identified on site. WSDOT and WDFW have provided a preliminary jurisdictional determination for the agricultural ditch, and WSDOT has provided boundary delineations and categorizations for wetlands located on their property off site to the north and east (Herrera 2022). Regulated buffers associated with the off-site ditch and wetland areas partially extend into the Main Development Area (per PMC 21.06). An area mapped as unverified wetland by the City of Puyallup located at Transportation and Utility parcel 0420201104 within the City of Fife was investigated by Anchor QEA biologists in May 2023 and was determined to be an upland area.

3.1 Soils

Natural Resources Conservation Service (NRCS)-mapped soils are shown in Figure 3. The underlying soils in the Study Area consist of Sultan silt loam and Puyallup fine sandy loam, with Pilchuck fine

sand mapped at the Transportation and Utility parcels to the south (USDA 2024). The NRCS Web Soil Survey (Figure 3; USDA 2024) identifies the following soil series in the vicinity of the Study Area:

- Pilchuck fine sand: This soil is very deep, excessively drained, and formed in recent sandy and gravelly alluvium on floodplains and moderate hill slopes. Pilchuck fine sand is not listed as hydric (USDA 2024). Permeability is very fast, and it has very low water table. Typically, the surface layer to 10 inches is very dark gray fine sand and the subsurface layer to 60 inches is black and very dark gray gravelly sand.
- Puyallup fine sandy loam: This soil is very deep, well drained with high saturated hydraulic conductivity and formed in mixed recent alluvium on floodplains and low stream terraces. Puyallup fine sandy loam is not listed as hydric (USDA 2024). Permeability is fast and it has a low water table. Typically, the surface layer to 10 inches is dark brown fine sandy loam and the subsurface layer to 60 inches is very dark grayish brown gravelly sand.
- Sultan silt loam: This soil is very deep, moderately well drained formed in recent alluvium on floodplains. Sultan silt loam is not listed as hydric (USDA 2024). Permeability is moderately slow, and it has a moderately high water table. Typically, the surface layer to 10 inches is very dark grayish brown silt loam and the subsurface layer to 60 inches is olive gray very fine sandy loam stratified with light gray medium sand.

Table 1 summarizes the soil mapping information for the Study Area. Puyallup silt loam, Puyallup fine sandy loam, and Sultan silt loam are not classified as hydric soils. but all three include minor hydric soil inclusions.

Table 1
Soils Mapped Within the Study Area by the NRCS Web Soil Survey

Map Unit	Soil Type Name	Drainage Class	Hydrologic Soil Group[1]	Hydric Soil Rating[2]	Hydric Inclusions[3]	Approx. % of Study Area
29A	Pilchuck silt loam	Excessively drained	A	No	Yes	45%
31A	Puyallup fine sandy loam	Well drained	A	No	Yes	25%
42A	Sultan silt loam	Moderately well drained	C/D	No	Yes	30%

Notes:

1. Hydrologic soil groups are based on runoff potential according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.
   i. Group A soils have low runoff potential and high infiltration rates even when thoroughly wetted. They chiefly consist of deep, well- to excessively drained sands or gravels and have a high rate of water transmission.
   ii. Group B soils have moderately low runoff potential when thoroughly wet, and water transmission through the soil is unimpeded.
   iii. Group C soils have slow infiltration rates when thoroughly wet, caused by either an underlying layer that impedes the downward movement of water or soils of moderately fine or fine texture.

iv. Group D soils have a very slow infiltration rate (high runoff potential) when thoroughly wet and include soils consisting of clays with high shrink-swell potential, soils that have a high water table, soils that have a clay or claypan layer at or near the surface, and soils that are shallow over nearly impervious material.
2. Hydric soil rating indicates the components of soil map units that meet the criteria for hydric soils.
3. Non-hydric soils may have inclusions of hydric soil in the lower positions on the landform.

3.2 Hydrology

The Study Area is located within Water Resource Inventory Area 10, the Puyallup-White Watershed, in the Puyallup subbasin (Hydrologic Unit Code [HUC] 17110014); the Lower Puyallup River Watershed (HUC 1711001405); and the Puyallup River Subwatershed (HUC 171100140502; Ecology 2023). Hydrologic characteristics within the property are influenced primarily by local precipitation, surface water runoff, and a high groundwater table, the areas that drain to the Puyallup River, which originates on Mount Rainier, and Wapato Creek, which is located several thousand feet to the north.

Two streams, Stream 14 and Stream 15, were identified within an off-site WSDOT-owned portion of the Study Area. Both Streams 14 and 15 are categorized as non-fish, perennial waters in WSDOT critical areas reporting (Herrera 2022; WSDOT 2023). One wetland, Wetland A, was identified to the south of the Main Development Area at parcels 0420201008, 0420201114, and 0420201115, and has been delineated and categorized as a Category II wetland (Section 4.2.2). During the Anchor QEA March 2022 field investigation, a small, disturbed area containing ponded water approximately 3 inches deep was identified at the east side of parcel 0420174075. This area has since been delineated and categorized as a Category III wetland (Wetland B; Section 4.2.2). WDFW PHS and SalmonScape data do not identify any freshwater surface stream channels to the Puyallup River or Wapato Creek within the Study Area (WDFW 2024a, 2024b).

3.3 Plant Communities

Some undisturbed native vegetation communities are located within the Study Area, but most of the vegetation is composed of open lawn areas, residential homes, grazing pastures, and paved and gravel roads, with small patches of planted native and ornamental trees and shrubs. The majority of the plantings are shrubs and ground cover species appear to receive regular maintenance. Areas of native vegetation are present within the undeveloped portions of the Transportation and Utility parcels located off site to the south and within the undeveloped portions of the WSDOT-owned parcels off site to the east of the Main Development Area. Photographs of the Study Area are included in Appendix B. Existing plant species within the Study Area are described in Section 4.4.2.

The Pierce County critical area maps (Figure 4; Pierce County 2024), USFWS NWI Wetlands Mapper (Figure 5; USFWS 2024a), and City of Puyallup wetland and stream maps (Figure 5; City of Puyallup 2024b) do not identify any freshwater wetland habitat within the Main Development Area (see

Figures 5, 6, and 7). Anchor QEA biologists did not identify any wetlands in the Main Development Area during the field investigation in October 2021. During the Anchor QEA March 2022 field investigation, Anchor QEA biologists identified and delineated Wetland B in a disturbed area at the east side of parcel 0420174075. Wetland B has since been rated as a Category III emergent, depressional wetland. Additional wetlands information is provided in Section 4.2. Buffers in association with the off-site wetlands and ditch in the WSDOT right-of-way are depicted in Figure 6.

4 Critical Areas Assessment

This section describes and assesses critical areas within and near the Study Area as defined per PMC Chapter 21 (City of Puyallup 2024a) and FMC Chapter 17 (City of Fife 2024a) including wetlands, streams, fish and wildlife habitat conservation areas, and frequently flooded areas.

4.1 Methods

To document and describe wetlands, streams, fish and wildlife habitat conservation areas, and frequently flooded areas within the Study Area, Anchor QEA reviewed existing information (Section 1.1) and performed an aerial photograph assessment. Anchor QEA biologists performed critical areas site visits to the Study Area on April 1 and September 28, 2021; March 11, 2022; May 19, 2023; April 12, 2024; and May 17, 2024, as part of the analysis for the Project. The entire Study Area was accessible during the investigation. During the site visits, Anchor QEA biologists documented general information regarding habitats and dominant plant species and communities. Potential wetland features were evaluated according to methods presented in the *U.S. Army Corps of Engineers Wetland Delineation Manual* (Environmental Laboratory 1987); the *Regional Supplement to the Corps of Engineers Wetland Delineation Manual: Western Mountains, Valleys, and Coast Region* (2010 Regional Supplement; USACE 2010); and *Field Indicators of Hydric Soils in the United States: A Guide for Identifying and Delineating Hydric Soils, Version 8.1, 2017* (USDA and NRCS 2016). Soil colors were classified by their numerical description as identified on a *Munsell Soil Color Chart* (Munsell 2000).

The ordinary high water mark (OHWM) of the streams—located off site in the WSDOT-owned portion of the Study Area to the east of the Main Development Area—was not delineated during the site visits. Additional information about the off-site streams was provided by WSDOT consultants (Herrera 2022; WSDOT 2023). All wildlife species, tracks, and other signs observed during the site visits were documented. These observations were qualitative; no quantitative wildlife surveys were performed. Photographs taken to document vegetation and habitat conditions are included in Appendix B.

This CAR evaluates terrestrial and aquatic habitats and plant communities based on physical observations. Existing information described in WDFW-documented species and priority habitats and ESA-listed species and critical habitats, within and near the Study Area, are also evaluated.

4.2 Wetlands

4.2.1 Main Development Area

One on-site wetland (Wetland B) was identified by Anchor QEA biologists at the east side of parcel 0420174075 and within the Main Development Area during the September 2021 and March 2022 site visits and categorized following the May 2023 site visit. Wetland data sheets for two data plots

(DPs) explored during the March 2022 site visits are provided in Appendix C. At DP-13, located at the center and at the lowest elevation of Wetland B, hydric soil and wetland hydrology were identified, but the area had no vegetation. However, during Anchor QEA's May 2023 site visit, it was observed that the previously unvegetated area had been recolonized by typical pasture grasses and other locally common emergent species.

Wetland conditions in this area are not documented by the City of Puyallup sensitive areas maps (City of Puyallup 2024b), Pierce County critical area maps (Figure 4; Pierce County 2024), USFWS NWI data (Figure 5; USFWS 2024a), or WDFW PHS data (WDFW 2024a), and do not identify wetland areas within at least 1,500 feet of the Study Area, except to the south of 19th Avenue Northwest at Transportation and Utility parcels 0420201008 and 0420201114.

Wetland B was previously thought to be regulated as an artificial wetland, based on excavation conducted by the previous landowner prior to the sale in November 2021. While the excavation was intentional, the creation of wetland conditions was not intentional. Ecology has determined that Wetland B will not be treated as an artificial wetland and is therefore regulated by state and local protections. An approved jurisdictional determination request was made to USACE and their decision (USACE 2024) is that "Wetland B is not a water of the U.S. and as such, work that would occur within these areas does not require Department of the Army authorization under Section 404 of the Clean Water Act" because it has no surface water connection to other known waters of the United States, meaning no permit from USACE is required to fill Wetland B.

4.2.2 Transportation and Utility Parcels 0420201008, 0420201114 and 0420201115

Transportation and Utility parcels 0420201008, 0420201114, and 042021115, located south of 19th Avenue Northwest and east of Freeman Road East in the City of Puyallup contain Wetland A and associated buffers (Figures 7 and 8). These buffers do not extend onto the Main Development Area north of 19th Avenue Northwest or west of Freeman Road East, because the buffer area is interrupted by the existing 19th Avenue Northwest and Freeman Road East roadways. Regulatory buffers only occur on the same side of an existing roadway as the wetland and do not extend to the opposite side from the sensitive area.

4.2.2.1 Sewer and Water Line Improvements

The Project proposes sewer and water utility lines that will be installed by connecting to and improving existing City of Puyallup public utility lines located within Freeman Road East. The utility lines will be routed south through Freeman Road East and then follow Levee Road East to the east. All sewer and water utility line construction will be located within the Freeman Road East and Levee Road East roadway prisms and within the public right-of-way. During the March 2022, May 2023, and May 2024 site investigations, Anchor QEA conducted additional wetland delineation work at Wetland A,

located east of Freeman Road East and North of Levee Road East, to confirm the utility work would not extend into the Wetland A or Wetland A buffer area. Anchor QEA Wetland A findings are recorded in 11 Wetland Determination Data Forms, and a preliminary rating is provided in Appendix C. The wetland delineation and data plot locations are depicted in Figure 7. Off-site Wetland A buffers will be avoided during construction of sewer and water utilities.

4.2.2.2 Stormwater Line and Facility Construction and Improvement

The Project proposes a new stormwater discharge utility line that will be constructed along Freeman Road East and a portion of Levee Road East between the Main Development Area and an existing stormwater discharge utility line located at Levee Road East. All stormwater utility line construction will be located within the Freeman Road East and Levee Road East roadway prisms and within the public right-of-way. The stormwater utility line design plan will not extend into Wetland A or Wetland A buffer area, and no impacts are anticipated. The existing stormwater line continues east along Levee Road East before ultimately being conveyed into the Puyallup River through an existing 84-inch culvert, located approximately 3/4 of a mile from the proposed discharge connection (Barghausen 2024). The Project also proposes a new stormwater facility located directly under the new road section of Freeman Road East just north of the intersection of Freeman Road East and Levee Road East. The stormwater facility will consist of a trench of clean, drainage rock. Collected stormwater runoff will be treated by proprietary storm filters prior to infiltration. The stormwater facility design plan and will not extend into Wetland A or Wetland A buffer area, alter the Wetland A hydrology, and no impacts are anticipated (Barghausen 2024).

4.2.2.3 Freeman Road, Levee Road and Intersection Improvements

The Project proposes to widen Freeman Road East onto parcel 0420201104 from two 11-foot-wide lanes to two 14-foot-wide lanes. The proposed east edge alignment of Freeman Road East will match the current location (with no impacts to parcel 0420201008), and all widening will occur on the west side of Freeman Road. The roadway widening will not impact Wetland A or the Wetland A buffer.

4.2.2.4 Gas Line Construction

The Project proposes a new Puget Sound Energy gas line that will be constructed along Freeman Road East and Levee Road East between the Main Development Area, and an existing stormwater gas utility line located at Levee Road East. All gas utility line construction will be located within the Freeman Road East and Levee Road East roadway prisms and within the public right-of-way. The gas utility line design will not extend into Wetland A or Wetland A buffer area, and no impacts are anticipated.

4.2.3 Transportation and Utility Parcel 0420201104

During the May 2023 site investigation, the full extent of Transportation and Utility parcel 040201104 in the City of Fife was walked by Anchor QEA biologists, and wetland conditions were not observed. Vegetation at Transportation and Utility parcel 040201104 is dominated by black cottonwood (*Populus balsamifera*), common snowberry (*Symphoricarpos albus*), osoberry (*Oemleria cerasiformis*), stinging nettle (*Urtica dioica*), Himalayan blackberry (*Rubus armeniacus*), and Japanese knotweed (*Reynoutria japonica*). Although the City of Fife (2024b) maps no wetlands on this parcel, the City of Puyallup maps a small low-lying portion near the southwest corner of parcel 040201104 as an unverified wetland (City of Puyallup 2024b). Anchor QEA biologists established DP-12 at this location (Figure 7) during the growing season and determined that hydrophytic vegetation was present, but that hydric soils and wetland hydrology were absent, meaning the area is not a wetland. A Wetland Determination Data Form for this location is included in Appendix C, and Site Photography is provided in Appendix B.

4.2.4 Transportation and Utility Parcel 0420174032

The Third-Party Review Report (Confluence 2022) also indicates an additional off-site wetland located to the northwest of the Main Development Area on the western edge of Freeman Road East at parcel 0420174032. Because Anchor QEA did not have permission to access the property, no delineation or rating information is provided in this report. A review of historical aerial imagery and observations from Freeman Road East made during the March 2022, May 2023, and April 2024 site investigations support the likely presence of wetlands at this location. The wetlands may cover much of the central portion of the parcel, and it likely contains PM1C and PSS1C Cowardin components. Any wetland buffers associated with this wetland are interrupted by Freeman Road East, which lies between the off-site wetland and the Main Development Area, and 48th Street East which would interrupt any wetland buffer at the northern edge of the existing roadway.

4.2.5 WSDOT-Owned Parcels 0420178009, 0420201110, 0420201111, 0420174028, and 0420174054

WSDOT provided documentation that show four off-site wetlands, identified as Wetland 87, Wetland 89, Wetland 93, and Wetland 146/148, located to the north and east of the Main Development Area at parcels 0420178009, 0420201110, 0420201111, 0420174028, 0420174054 and within the WSDOT right-of-way (Herrera 2022; WSDOT 2023; Figure 6). Wetland 87 is located east of Main Development Area parcel 0420205016 on WSDOT-owned parcel 0420201110. Wetland 89 is located on WSDOT-owned parcel 0420201111 and is about 300 feet directly east of Main Development Area parcel 0420201027. Wetland 93 is an emergent wetland within an agricultural field located northeast of Main Development Area parcel 0420174075 and covers much of WSDOT-owned parcel 0420178009. Wetland 146/148 is located north of Main Development Area parcel 0420174075 and covers the

southern portion of WSDOT-owned parcels 0420174028 and 0420174054. Rating and buffer information for Wetlands 87, 89, 93, and 146/148 is provided in Section 5.2.3, and rating forms and figures are provided in Appendix C.

4.3 Streams

No streams, drainage channels, seeps, or associated riparian habitats were observed by Anchor QEA biologists within the Main Development Area during the 2021, 2022, 2023, and 2024 site visits. Additionally, WDFW PHS data (WDFW 2024a), SalmonScape data (WDFW 2024b), and City of Puyallup sensitive areas maps (City of Puyallup 2024b) do not identify any stream channels other than the Puyallup River within 2,000 feet of the Study Area. Pierce County critical area maps (Pierce County 2024) identify Wapato Creek north of the Study Area and the Puyallup River south of the Main Development Area, but they are not located within the Study Area and will not be affected by the Project.

Two streams (Streams 14 and 15) are located adjacent to the Main Development Area within the off-site WSDOT-owned parcels 0420174028, 0420178009, 0420201110, and 0420201111. They appear to be artificially created linear features that join off site to the east of Main Development Area parcel 0420174075. The combined stream (Stream 15) drains from the southeast to the northwest, turns to the west, crosses Freeman Road East, then flows through City of Fife parcels 0420174032, 0420174031, 0420174015, and 0420174707. Anchor QEA's review of the preliminary WSDOT State Route 167 Completion Project critical area assessment indicates that Streams 14 and 15 will be regulated as Type III streams protected by 50-foot-wide buffers, per PMC Chapter 21 (City of Puyallup 2024a), which will partially project onto parcel 0420174075 and 0420205016. For the purposes of this assessment, a 50-foot-wide stream buffer has been applied to the off-site Streams 14 and 15. Preliminary mitigation planning for the WSDOT State Route 167 Completion Project provided in Appendix D indicates that the streams will be relocated further to the east within the WSDOT-owned parcels and that the riparian buffer areas will no longer project into the Main Development Area parcels (WSDOT 2023).

The City of Puyallup and Third-Party Review Reports (Confluence Environmental Group 2022, 2024a) indicated in previous comments that a potential stream or ditch was present along the west side of Freeman Road on or adjacent to parcel 0420174032. During the May 2023 and April 2024 site visits, Anchor QEA biologists inspected this area and found no evidence of an OHWM or other indicators that suggested the presence of flowing water along the west side of Freeman Road East. The area includes a narrow swale at lower elevation, but this does not necessarily qualify as a stream.

4.4 Fish and Wildlife Habitat Conservation Areas

Per PMC 21.06.210 fish and wildlife habitat conservation areas are areas that serve a critical role in sustaining needed habitats and species for the functional integrity of the ecosystem, and which, if

altered, may reduce the likelihood that the species will persist over the long term. These areas may include, but are not limited to, rare or vulnerable ecological systems, communities, and habitat or habitat elements including seasonal ranges, breeding habitat, winter range, and movement corridors, and areas with high relative population density or species richness. These areas also include locally important habitats and species as determined by the City of Puyallup. These areas do not include such artificial features or constructs as irrigation delivery systems, irrigation infrastructure, irrigation canals, or drainage ditches that lie within the boundaries of and are maintained by a port district or an irrigation district, unless these features are documented as being used by salmonids for habitat.

4.4.1 Streams

Streams 14 and 15 are located outside of the Main Development Area off site to the north, east, and southeast of parcel 0420174075. The preliminary WSDOT State Route 167 Completion Project critical area assessment indicates that Streams 14 and 15 are degraded ditches with poor riparian buffer conditions that convey water through off-site WSDOT-owned parcels 0420201111, 0420201110, 0420178009, and 0420174028, from the southeast to the northwest, where the combined stream then crosses Freeman Road and flows to the west through City of Fife parcels 0420174032, 0420174031, 0420174015, and 0420174707. Instream conditions in Streams 14 and 15 are poor with a lack of channel complexity and substrate dominated by mud and silt. WDFW fish passage data indicates that a culvert crossing beneath Freeman Road East about 650 feet downstream of Streams 14 and 15 prevents fish passage onto the WSDOT-owned parcels in the vicinity of the Study Area (WDFW 2021; Herrera 2022). The preliminary WSDOT State Route 167 Completion Project critical area assessment indicates that Streams 14 and 15 are Type III Streams and are protected by a standard 50-foot-wide buffer per PMC 21.06.1050. A 3,447-square-foot portion of Stream 14 and 15 buffers extends onto the Main Development Area parcel 0420174075 and 0420205016.

4.4.2 Vegetation

Some undisturbed native vegetation communities are located within the Study Area. Areas of native vegetation occur east and south of the Main Development Area. Native plant species observed include black cottonwood (*Populus balsamifera*), red alder (*Alnus rubra*), red osier dogwood (*Cornus sericea*), Oregon ash (*Fraxinus latifolia*), Pacific crabapple (*Malus fusca*), common snowberry (*Symphoricarpos albus*), Nootka rose (*Rosa nutkana*), salal (*Gaultheria shallon*), northern bracken fern (*Pteridium aquilinum*), and field horsetail (*Equisetum arvense*). Many invasive species or noxious weeds were also noted as present, including include English ivy (*Hedera helix*), English holly *(Ilex aquifolium*), Himalayan blackberry (*Rubus armeniacus*), evergreen blackberry (*Rubus laciniatus*), Canada thistle (*Cirsium arvense*), and reed canary grass *(Phalarais arundinacea*).

Areas located west of the fence line in the agricultural pastures included varieties of *Agrostis* and *Fescue* grasses, which appeared to be regularly mowed or were previously grazed by sheep and llamas. Photographs of vegetation in the Study Area are included in Appendix B.

4.4.3 Wildlife and Habitat

The majority of the Study Area includes a managed landscape with mowed grass and ornamental vegetation. Potential habitat is limited to the small patches of native vegetation along the eastern and southern property boundaries. Wildlife use of the terrestrial habitat is likely dominated by disturbance-tolerant species typical of urban areas. Habitat surrounding the Study Area includes fragmented and disturbed areas associated with residential and industrial development. Wildlife species observed during the site visits included bird species common in urban areas of Pierce County, including crows (*Corvus brachyrhynchos*), house sparrows (*Passer domesticus*), and gull species (*Larus* spp.). No amphibian, reptile, or mammal species; tracks or other signs were observed during the site visits.

The Study Area hydrology provides limited habitat for aquatic species. The habitat within Wetland B and Streams 14 and 15 located on the WSDOT-owned parcels north and east of the Main Development Area are dominated by shallow standing water with little to no noticeable flow, degraded riparian areas and do not provide habitat for salmonid species due to a downstream culvert crossing at Freeman Road East that blocks fish passage further upstream.

Streams 14 and 15 are regulated as Type III streams because they are not used by anadromous fish (no fish species have been documented in the streams; WDFW 2021; Herrera 2022; WSDOT 2023) and it is wider than 2 feet. According to PMC 21.06.1050, Type III, streams require buffers of 50 feet.

4.4.4 Priority Species and Habitats

The WDFW PHS data (WDFW 2024a) do not document occurrences of any terrestrial species or priority habitats in the Study Area. No fish species have been documented in off-site Streams 14 and 15 according to the WDFW PHS and SalmonScape (WDFW 2024b) websites.

4.4.4.1 ESA-Listed Species and Critical Habitat

The assessment for ESA-listed species and critical habitats for this Project was performed based on data provided for the Study Area. The following subsections describe ESA-listed species and critical habitats that may occur in the vicinity of the Study Area.

ESA-listed species and critical habitats under NMFS and USFWS jurisdiction in Western Washington are referenced on the agencies' websites. NMFS identifies ESA-listed species that occur or may occur within a broad geographic area, such as an evolutionarily significant unit or a distinct population

segment, rather than a project-specific location (NMFS 2024). The USFWS identifies ESA-listed species that occur or may occur within a specific location where a project is proposed (USFWS 2024b).

4.4.4.2 Federally Listed Species That May Occur in the Study Area

The May 2024 status of federally listed species and critical habitats protected under the ESA that occur or may occur within the Study Area is presented in Table 2. As shown in Table 2, three ESA-listed bird species occur or may occur within the Study Area. One ESA candidate insect species is identified as potentially occurring within the Study Area. Four ESA-listed fish species are present in the nearby Puyallup River: steelhead trout (*Oncorhynchus mykiss*), Chinook salmon (*O. tshawytscha*), bull trout (*Salvelinus confluentus*), and Dolly Varden (*S. malma*). All four have designated critical habitat in the Puyallup River. However, these species do not occur or are very unlikely to occur in the Study Area based on the species' life history and habitat requirements. Fish species listed in Table 2 are located within the Puyallup River but not in off-site Streams 14 and 15. These species would not be susceptible to impacts related to construction, as no in-water work is proposed, but they are relevant considering the Project is located within the Puyallup River floodplain. No ESA-listed plant or mammal species are identified as potentially occurring within the Study Area.

Table 2
Federally Listed Species That May Occur in Study Area

Species	Status	Agency	Critical Habitat
Birds			
Marbled murrelet (*Brachyramphus marmoratus*)	Threatened	USFWS	Designated (does not include Study Area)
Streaked horned lark (*Eremophila alpestris strigata*)	Threatened	USFWS	Designated (does not include Study Area)
Yellow-billed cuckoo (*Cocczyus americanus*)	Threatened	USFWS	Designated (does not include Study Area)
Insects			
Monarch butterfly (*Danaus plexippus*)	Candidate	USFWS	Not designated
Fish			
Steelhead trout (*Oncorhynchus mykiss*)	Threatened	NMFS	Designated – Puyallup River
Chinook salmon (*Oncorhynchus tshawytscha*)	Threatened	NMFS	Designated – Puyallup River
Bull trout (*Salvelinus malma/S. confluentus*)	Threatened	USFWS	Designated – Puyallup River
Dolly Varden (*S. malma/S. confluentus*)	Threatened	USFWS	Designated – Puyallup River

Marbled murrelets are more commonly associated with marine habitat instead of the freshwater habitat in the Study Area. The urbanized and industrial areas within the Study Area are unfavorable to marbled murrelets, streaked horned larks, and yellow-billed cuckoos.

4.5 Special Flood Hazard Areas

The Puyallup River flows approximately 1,200 feet south of the Main Development Area, south of North Levee Road East. The Study Area is located within the 100-year floodplain of the Puyallup River within Federal Emergency Management Agency (FEMA) Flood Zone AE (FEMA 1999). The base flood elevation (BFE) for the Puyallup River is 33 feet North American Vertical Datum of 1988 (NAVD88); however, the levee along North Levee Road East is not officially certified, meaning the floodplain is mapped as extending onto the Study Area. Per PMC 21.07, the floodplain within the Study Area is a special flood hazard area and a habitat assessment has been prepared by a qualified professional to evaluate the effects and/or indirect effects of the proposed development (during both construction and operation) on floodplain functions. Section 6.3 of this report includes this assessment and documents that the proposed development will not result in impacts to any species listed as threatened or endangered under the ESA.

5 Wetland Delineation

Anchor QEA wetland scientists performed wetland delineation field work on March 11, 2022; May 19, 2023; and May 17, 2024. One wetland was delineated off site: Wetland A, a Category II emergent, scrub-shrub and forested depressional wetland located to the south of 19th Avenue Northwest, east of Freeman Road East, and north of Levee Road East. One wetland was delineated on site: Wetland B, a Category III emergent depressional wetland located on the eastern portion of parcel 0420174075. Following Anchor QEA's review of the Third-Party Review Reporting (Confluence Environmental Group 2022; 2024a) and WSDOT mitigation plans (WSDOT 2023), Anchor QEA also identified five other off-site wetlands, with four delineated on the WSDOT-owned properties to the north and east and one possible, unstudied wetland located to the west of Freeman Road East on parcel 0420174032. Figure 6 provides a preliminary depiction of the off-site wetlands and how their anticipated buffers may extend onto the Main Development Area portion of the Study Area. The possible wetlands located to the west of Freeman Road East on parcel 0420174032 and on either side of 78th Avenue East are not discussed further because they have not been delineated or categorized, and because any associated buffer is interrupted by the existing Freeman Road East, 48th Avenue East, and 78th Avenue East roadways.

The following sections describe the methodology and results of the wetland delineations. Critical areas figures are attached to this CAR, including wetland delineation results in Figures 6 and 7. Site photos are included in Appendix B, wetland determination data forms and wetland rating forms are provided in Appendix C.

5.1 Methodology

This section describes the methodology used to perform the wetland delineation, including a review of existing information and field investigation procedures. These methods are consistent with current federal and state agency requirements, as well as local jurisdiction requirements, for performing wetland delineations and identifying protective wetland buffer widths.

Field work was conducted according to methods presented in the *U.S. Army Corps of Engineers Wetland Delineation Manual* (Environmental Laboratory 1987); 2010 Regional Supplement (USACE 2010); and *Field Indicators of Hydric Soils in the United States: A Guide for Identifying and Delineating Hydric Soils, Version 8.1, 2017* (USDA and NRCS 2016). Soil colors were classified by their numerical description as identified on a *Munsell Soil Color Chart* (Munsell 2000).

The U.S. Army Corps of Engineers defines wetlands as follows:

> Those areas that are inundated or saturated by surface or groundwater at a frequency and duration sufficient to support, and that under normal circumstances do support, a prevalence of vegetation typically adapted for

> life in saturated soil conditions. Wetlands generally include swamps, marshes, bogs, and similar areas. (Environmental Laboratory 1987)

The method for delineating wetlands is based on the presence of three parameters: hydrophytic vegetation, hydric soils, and wetland hydrology. Hydrophytic vegetation is "the macrophytic plant life that occurs in areas where the frequency and duration of inundation or soil saturation produce permanently or periodically saturated soils of sufficient duration to exert a controlling influence on the plant species present" (Environmental Laboratory 1987). Hydric soils are "formed under conditions of saturation, flooding, or ponding long enough during the growing season to develop anaerobic conditions in the upper part" (Environmental Laboratory 1987). Wetland hydrology "encompasses all hydrologic characteristics of areas that are periodically inundated or have soils saturated to the surface for a sufficient duration during the growing season" (Ecology 1997). Data collection methods for each of these parameters are described in the following subsections.

A total of 14 DPs were sampled and recorded. Vegetation, soils, and hydrology information were collected at each of the plots and recorded on field data sheets (Appendix C). Wetland boundaries were determined based upon plot data and visual observations of the wetland. The wetland location, wetland boundary, and DP locations were flagged and recorded by Anchor QEA wetland scientists using a Trimble Geo7x GPS unit.

5.1.1 Vegetation

Plant species occurring in each plot were recorded on field data forms, with one data form per plot. Percent cover for each plant species was estimated in the plot, and dominant plant species were identified. At each plot, trees within a 30-foot radius, shrubs and saplings within a 15-foot radius, and herb and forb species within a 5-foot radius from the center of the plot were identified and recorded. Plant indicator status was determined using the National Wetland Plant List: 2016 Wetland Ratings (Lichvar et al. 2016), and a determination was made as to whether the vegetation in the plot was hydrophytic. To meet the hydrophytic parameter, more than 50% of the dominant species, with 20% or greater cover, must have an indicator of obligate wetland (OBL), facultative wetland (FACW), or facultative (FAC). Table 3 shows the definitions for each wetland indicator status category.

Table 3
Wetland Plant Indicator Status Definitions

Indicator Status	Description
Obligate Wetland (OBL)	Plant species occur almost always in wetlands (estimated probability greater than 99%) under natural conditions.
Facultative Wetland (FACW)	Plant species usually occur in wetlands (estimated probability 67% to 99%) but are occasionally found in non-wetlands.

Indicator Status	Description
Facultative (FAC)	Plant species are equally likely to occur in wetlands or non-wetlands (estimated probability 34% to 66%).
Facultative Upland (FACU)	Plant species usually occur in non-wetlands (estimated probability 67% to 99%) but are occasionally found in wetlands.
Obligate Upland (UPL)	Plant species occur almost always in non-wetlands (estimated probability greater than 99%) under natural conditions.

Source: Reed 1988

5.1.2 Soils

Soils were sampled in each plot and evaluated for hydric soil indicators. Soil pits were dug to a depth of 18 inches, unless a restrictive layer was present. Hydric soil indicators include low soil matrix chroma, gleying, and redoximorphic (redox) features. Redox features are spots of contrasting color that occur within the soil matrix (the predominant soil color). Gleyed soils are predominantly bluish, greenish, or grayish in color.

5.1.3 Hydrology

Wetland hydrology was evaluated at each plot to determine whether it "encompasses all hydrologic characteristics of areas that are periodically inundated or have soils saturated to the surface for a sufficient duration during the growing season" (Ecology 1997). Field observations of saturation, inundation, and other indicators of wetland hydrology, such as water-stained leaves and drainage patterns in wetlands, were recorded.

5.1.4 Wetland Community Types

Wetland community types are discussed according to the USFWS classification developed by Cowardin et al. (1979) for use in the NWI (Cowardin system). This system, published in 1979 by a team of USFWS scientists led by L.M. Cowardin, bases the classification of wetlands on their physical characteristics, such as the general type of vegetation in the wetland (e.g., trees, shrubs, grass) and how much, and where, water is present in the wetland. The Cowardin system provides a classification for every known wetland type that occurs throughout the United States, and under this system a wetland can be classified as having one or more wetland community types. The community types found during this investigation included the following:

- **Palustrine emergent (PEM):** These wetlands have erect, rooted, herbaceous vegetation present for most of the growing season in most years.
- **Palustrine scrub-shrub (PSS):** These wetlands have 30% cover of woody vegetation that is less than 20 feet high.
- **Palustrine forested (PFO):** These wetlands have at least 30% cover of woody vegetation that is at least 20 feet high.

5.1.5 Wetland Ratings

Wetland ratings were determined using the most current version of the *Washington State Wetland Rating System for Western Washington: 2014 Update* (Washington rating system; Hruby 2014) and according to the City of Puyallup wetland rating criteria, as defined in the PMC. The Washington rating system was updated by Ecology as of January 1, 2015.

The system developed by Ecology is used to differentiate wetlands based on their sensitivity to disturbance, their significance in the watershed, their rarity, our ability to replace them, and the beneficial functions they provide to society. The Washington rating system requires the user to collect specific information about the wetland in a step-by-step process. Three major functions are analyzed: water quality improvement, hydrologic functions, and wildlife habitat. Ratings are based on a point system, where points are given if a wetland meets specific criteria related to the wetland's potential and opportunity to provide certain benefits.

Per the Washington rating system, wetlands are categorized according to the following criteria and associated point system where points are awarded to three functional value categories (water quality improvement, hydrologic functions, and habitat):

- **Category I wetlands** (23 or more points) represent a unique or rare wetland type, are more sensitive to disturbance, or are relatively undisturbed and contain ecological attributes that are impossible to replace within a human lifetime.
- **Category II wetlands** (20 to 22 points) are difficult, though not impossible, to replace and provide high levels of some functions.
- **Category III wetlands** (16 to 19 points) have moderate levels of functions. They have been disturbed in some ways and are often less diverse or more isolated from other natural resources in the landscape than Category II wetlands.
- **Category IV wetlands** (less than 16 points) have the lowest levels of functions and are often heavily disturbed.

PMC classifies wetlands into four categories (categories I, II, III, and IV) based on the Washington rating system.

5.1.6 Wetlands Function Assessment

The functions of wetlands were rated according to the Washington rating system. Using this system, wetlands were rated based on points awarded to three categories of functions: water quality, hydrologic functions, and wildlife habitat. Detailed scoring, based on Washington wetland rating forms, is provided in Appendix C.

5.1.7 State Hydrogeomorphic Classification System

Scientists have come to understand that wetlands can perform functions in different ways. The way a wetland functions depends to a large degree on hydrologic and geomorphic conditions. To recognize these differences among wetlands, a way to group or classify them has been developed. This classification system, called the hydrogeomorphic (HGM) classification, groups wetlands into categories based on the geomorphic and hydrologic characteristics that control many functions.

The Washington rating system incorporates the HGM classification as part of the questionnaire for characterizing a wetland's functions. The Washington rating system uses only the highest grouping in the HGM classification: wetland class. Wetland classes are based on geomorphic settings, such as riverine, slope, lake fringe, or depressional. A classification key is provided within the rating form to help identify which of the following HGM classifications apply to the wetland: riverine, depressional, slope, lake fringe, tidal fringe, or flats.

5.2 Results

Anchor QEA wetland scientists delineated one wetland (Wetland A; off site) and one wetland (Wetland B; on site) within the Study Area (Figure 7). These wetlands are summarized in Tables 4 and 5 and described in more detail in the following subsections. Site photographs showing these features are included in Appendix B. Wetland determination data forms and wetland rating forms are provided in Appendix C.

Table 4
Wetlands Delineated by Anchor QEA Within the Study Area

Wetland	Cowardin Class[1]	HGM Class	Category	Total Wetland Area	
				Square Feet	Acres
A	PEM1C, PSS1C PFO1C	Depressional	II	468,674	10.76
B	PEM1C	Depressional	III	1,218	0.03

Note:

1. PEM1C: palustrine, emergent, persistent, seasonally flooded; PSS1: palustrine, scrub-shrub, persistent, seasonally flooded: PFO1C: palustrine, forested, persistent, seasonally flooded

For the Washington rating system, a low, moderate, or high rating is based on three functions: improving water quality, hydrologic, and habitat. Within each of these three functions are three subfunction categories: site potential, landscape potential, and value. Each of these subfunction categories is rated as low, moderate, or high. Wetland functions and scores for Wetland A and Wetland B using the Washington rating system are shown in Table 5. The Washington wetland rating forms are provided in Appendix C.

Table 5
Summary of Scores for Wetland Functions and Values

Wetland and Function	Improving Water Quality	Hydrologic	Habitat	Total Functions Score[1]	Washington State Rating	Puyallup Rating
Off-Site Wetland A						
Site Potential	Moderate	High	Moderate	--	--	--
Landscape Potential	Moderate	High	Low	--	--	--
Value	High	High	High	--	--	--
Score Based on Rating[1]	7	9	6	22	II	II
On-Site Wetland B						
Site Potential	Moderate	Moderate	Low	--	--	--
Landscape Potential	Moderate	Moderate	Low	--	--	--
Value	High	High	High	--	--	--
Score Based on Rating[1]	7	7	5	19	III	III

Notes:
Potential total score per function is 9, for a potential total score of 27.

The following sections describe the wetlands identified during Anchor QEA's field investigations and wetland delineation. The wetland is classified and rated according to the Cowardin system and the Washington rating system.

5.2.1 Wetland A

Wetland A is 10.76 acres (468,674 square feet) with PEM, PSS, and PFO vegetation classes and has a depressional HGM classification. The approximate wetland position is mapped on Pierce County's PublicGIS wetland inventory (Figure 4; Pierce County 2024). In March 2022, Anchor QEA biologists provided an additional delineation along the northern and eastern boundaries of Wetland A. In May 2023 and May 2024, Anchor QEA biologists provided additional delineations along the western and southern boundaries and the current extent was confirmed (Figure 7).

5.2.1.1 Vegetation

Wetland A is dominated by forest vegetation species such as black cottonwood (*Populus trichocarpa*; FAC), red alder (*Alnus rubra*; FAC), Oregon ash (*Fraxinus latifolia*; FACW), and red osier dogwood (*cornus sericea*; FACW), interspersed with a few patches of Himalayan blackberry (*Rubus armeniacus*; FAC). Other species found along the edge of the wetland include Sitka spruce (*Picea sitchensis*; FAC), osoberry (*Oemleria cerasiformis;* FACU), snowberry (*Symphoricarpos albus*; FACU), red current (*Ribes*

sanguineum; FACU), salmonberry (*Rubus spectabilis*; FAC), and common ivy (*Hedera helix*; FACU). Wetland A Cowardin vegetation classes are presented in Appendix C.

Overall, the vegetation in Wetland A meets the dominance test for hydrophytic vegetation indicator and satisfies the hydrophytic vegetation criteria of the 2010 Regional Supplement (USACE 2010).

5.2.1.2 Soils

Soils in Wetland A are mapped as Pilchuck fine sand, a soil type that is classified as hydric. The soils observed in Wetland A were generally dark at the surface, with a depleted matrix below and redoximorphic features increasing with depth. Upon inspection, the predominant textures were confirmed to be silt loam and sandy loam.

Overall, soil samples met the Depleted Below Dark Surface (A11) hydric soil indicator, satisfying the hydric soil criteria of the 2010 Regional Supplement.

5.2.1.3 Hydrology

Wetland hydrology was confirmed in Wetland A at two data points by surface water (A1), high water table (A2), saturation (A3), inundation visible on aerial imagery (B7), sparsely vegetated concave surface (B8), and water-stained leaves (B9). The primary water regimes of Wetland A were determined to be permanently flooded, seasonally flooded, and saturated.

5.2.1.4 Boundary Determination

The wetland and upland boundaries of Wetland A were determined by an abrupt change in topography and the presence of hydric soils, wetland hydrology, and hydrophytic vegetation. To confirm the current Wetland A extent, Anchor QEA biologists delineated the northern and eastern wetland boundaries in March 2022 and the southern and western boundaries of Wetland A were delineated in May 2023 and May 2024.

5.2.1.5 Wetland Functions Scores and Rating

Wetland A is rated as a Category II wetland, with a score of seven for water quality functions, a score of nine for hydrologic functions, and a score of six for habitat functions. The ratings are discussed in more detail in the following sections, and the wetland rating form for Wetland A is provided in Appendix C.

5.2.1.5.1 Water Quality Functions

Wetland A has moderate function for improving water quality site potential, moderate function for landscape potential components, and high function for the value component based on the Washington rating system. Contributing factors to this functional rating include that the wetland is in a depression with no surface water leaving it (no outlet), persistent ungrazed plants covering more

than 50% of the wetland, the absence of septic systems within 250 feet, and the presence of a 303(d)-listed aquatic resource within the subbasin.

5.2.1.5.2 Hydrologic Functions

Wetland A has high hydrologic functions for site potential, landscape potential, and value based on the Washington rating system. Factors that contribute to this functional rating include marks of ponding greater than 3 feet deep, intensive land uses within the subbasin, stormwater discharging directly into the wetland, and surface flooding problems in a subbasin immediately downgradient from the wetland.

5.2.1.5.3 Habitat Functions

Wetland A has moderate, low, and high habitat functions for site potential, landscape potential, and value, respectively, based on the Washington rating system. Factors that contribute to this functional rating include: the presence of three Cowardin plant classes and three hydroperiods; large, downed woody debris; standing snags; stable steep banks of fine material; thin-stemmed persistent plants for amphibian habitat; adjacent high land use intensity; and the lack of nearby undisturbed habitat.

5.2.2 Wetland B

Wetland B is 0.03 acre (1,218 square feet) with PEM vegetation and has a depressional HGM classification (Figure 7). The approximate wetland position is not mapped on Pierce County's PublicGIS wetland inventory (Pierce County 2024) or on the USFWS NWI (Figure 5; USFWS 2024a). In May 2023 Anchor QEA biologists provided an additional delineation and confirmed the current wetland extent.

5.2.2.1 Vegetation

Wetland B is dominated by emergent vegetation species including pasture grasses (*Agrostis and Fescue species*; assumed FAC).

Overall, the vegetation in Wetland A meets the dominance test hydrophytic vegetation indicator and satisfies the hydrophytic vegetation criteria of the 2010 Regional Supplement (USACE 2010).

5.2.2.2 Soils

Soils in Wetland B are mapped as Sultan silt loam, a soil type that is not classified as hydric. The soils observed in Wetland B were found to have a depleted matrix below and redoximorphic features increasing with depth. Upon inspection, the predominant textures were confirmed to be silt loam.

Overall, soil samples met the depleted matrix (F3) hydric soil indicator, satisfying the hydric soil criteria of the 2010 Regional Supplement.

5.2.2.3 Hydrology

Wetland hydrology was confirmed in Wetland B at one data point by surface water (A1), and saturation (A3). The primary water regimes of Wetland B were determined to be seasonally flooded, and saturated. Wetland B shares no permanent or continuous connection to other surface water features.

5.2.2.4 Boundary Determination

The wetland and upland boundaries of Wetland B were determined the presence of hydric soils, wetland hydrology, and hydrophytic vegetation.

5.2.2.5 Wetland Functions Scores and Rating

Wetland B is rated as a Category III wetland, with a score of seven for water quality functions, a score of seven for hydrologic functions, and a score of five for habitat functions. The ratings are discussed in more detail in the following sections, and the wetland rating form for Wetland B is provided in Appendix C.

5.2.2.5.1 Water Quality Functions

Wetland B has moderate, moderate, and high water quality functions based on the Washington rating system for site potential, landscape potential, and value, respectively. Contributing factors to this functional rating the wetland's position within a depression with no surface water leaving it (no outlet), persistent ungrazed plants covering more than 50% of the wetland, the absence of septic systems within 150 feet, and the presence of a 303(d)-listed aquatic resources within the subbasin.

5.2.2.5.2 Hydrologic Functions

Wetland B has moderate, moderate, and high hydrologic functions based on the Washington rating system for site potential, landscape potential, and value, respectively. Factors that contribute to this functional rating include marks of ponding less than 6 inches deep, the relatively small size of the contributing basin, a lack of stormwater discharging directly into the wetland, and surface flooding problems in a subbasin immediately downgradient from the wetland.

5.2.2.5.3 Habitat Functions

Wetland B has low, low, and high habitat functions based on the Washington rating system for site potential, landscape potential, and value, respectively. Factors that contribute to this functional rating include: the presence of a single Cowardin plant classes and two hydroperiods; the absence of downed woody debris, standing snags, stable steep banks of fine material and thin-stemmed persistent plants for amphibian habitat; low richness of plant species and interspersion of habitat, adjacent high land use intensity; and the lack of nearby undisturbed habitat.

5.2.3 WSDOT-Owned Parcel Wetlands

Four wetlands, identified as Wetland 87, Wetland 89, Wetland 93, and Wetland 146/148 (Figure 6), were delineated by WSDOT consultants on the WSDOT-owned parcels (Herrera 2022; WSDOT 2023). Wetland 87 is located southwest of the confluence of Stream 14 and Stream 15 at the northeast portion of parcel 0420201110. WSDOT consultants assigned Wetland 87 a Category III rating with a habitat score of six points. Wetland 89, located directly north of 19th Avenue Northwest, was assigned a Category II rating by WSDOT consultants with a habitat score of five points. Wetland 93 is located north of Stream 14 and east of Stream 15 and covers much of parcel 0420178009. WSDOT consultants assigned Wetland 93 a Category III rating with a habitat score of four points. Wetland 146/148 is located south of Stream 15 at the southern portion of parcels 0420174028 and 0420174054. WSDOT consultants assigned Wetland 146/148 a Category III rating with a habitat score of four points. Table 6 provides a summary of the off-site WSDOT wetland information.

Table 6
Off-Site WSDOT Wetlands

Wetland	Cowardin Class[1]	HGM Class	Category	Total Wetland Area	
				Square Feet	Acres
WL87	PSS, PFO	Depressional	III	2,745	0.63
WL89	PSS	Depressional	II	5,645	0.13
WL93	PEM	Depressional	III	293,494	6.74
WL146/148	PEM, PSS	Depressional	III	22,128	0.53

Note:
1. PEM: palustrine, emergent wetland; PSS: palustrine, scrub-shrub wetland; PFO: palustrine, forested wetland.

For the Washington rating system, a low, moderate, or high rating is based on three functions: improving water quality, hydrologic, and habitat. Within each of these three functions are three subfunction categories: site potential, landscape potential, and value. Each of these subfunction categories is rated as low, moderate, or high. Wetland functions and scores for Wetlands 87, 89, 93, and 146/148 using the Washington rating system are shown in Table 7. The Washington wetland rating forms provided by WSDOT consultants are included in Appendix C.

Table 7
Summary of Scores for WSDOT Wetland Functions and Values

Wetland and Function	Improving Water Quality	Hydrologic	Habitat	Total Functions Score[1]	Washington State Rating	Puyallup Rating
Wetland 87						
Site Potential	Moderate	Moderate	Moderate	--	--	--

Wetland and Function	Improving Water Quality	Hydrologic	Habitat	Total Functions Score[1]	Washington State Rating	Puyallup Rating
Landscape Potential	Moderate	Moderate	Low	--	--	--
Value	High	Moderate	High	--	--	--
Score Based on Rating[1]	7	7	6	19	III	III
Wetland 89						
Site Potential	Moderate	Moderate	Low	--	--	--
Landscape Potential	High	High	Low	--	--	--
Value	High	Moderate	High	--	--	--
Score Based on Rating[1]	8	7	5	20	II	II
Wetland 93						
Site Potential	Low	Moderate	Low			
Landscape Potential	High	High	Low			
Value	High	Moderate	Moderate			
Score Based on Rating[1]	7	7	4	18	III	III
Wetland 146/148						
Site Potential	Moderate	Low	Low			
Landscape Potential	High	High	Low			
Value	High	Moderate	Moderate			
Score Based on Rating[1]	8	6	4	18	III	III

Note:
Potential total score per function is 9, for a potential total score of 27.

5.3 Puyallup Wetland Buffer Guidance

Required wetland buffers have been identified according to the current PMC. PMC 21.06.930 identifies minimum protective buffer widths for wetlands based on the Ecology habitat rating score, per the Washington rating system, level of function for habitat and water quality improvement, and land use intensity.

Per PMC 21.06.930 2 (C), the minimum proposed buffer width for a Category II wetland with a high land use intensity on the upland side of the buffer, low level for habitat function (less than six points) and high level of function for water quality improvement (eight to nine points) is 100 feet, measured

from the wetland boundary as delineated in the field. Therefore, the proposed buffer width for Wetland 89 is 100 feet. The Wetland 89 buffer does not project onto the Main Development Area (Figure 6).

Per PMC 21.06.930 2 (C), the minimum proposed buffer width for a Category II wetland with a moderate habitat score of six to seven points and high land use intensity on the upland side of the buffer is 150 feet. Therefore, the proposed buffer width for Wetland A is 150 feet. However, any Wetland A buffer that may project onto the Main Development Area is interrupted by an existing roadway (19th Avenue Northwest) that lies between Wetland A and the Main Development Area. The Wetland 93 buffer partially projects onto the Main Development Area and is not interrupted by a roadway or other existing development (Figure 6).

Per PMC 21.06.930 2 (D), the minimum proposed buffer width for a Category III wetland with a habitat score of less than six points and high land use intensity on the upland side of the buffer is 80 feet, measured from the wetland boundary as delineated in the field. Therefore, the proposed buffer width for Wetland B, Wetland 93, and Wetland 146/148 is 80 feet.

Per PMC 21.06.930 2 (D), the minimum proposed buffer width for a Category III wetland with a moderate habitat score of six to seven points, and high land use intensity on the upland side of the buffer is 150 feet. Therefore, the proposed buffer width for Wetland 87 is 150 feet. The Wetland 87 buffer partially projects onto the Main Development Area and is not interrupted by a roadway or other existing development (Figure 6).

Table 8 provides a summary of wetland functional ratings and proposed wetland buffer widths.

Table 8
Proposed Wetland Buffer Widths

Wetland	Improving Water Quality	Habitat	Category	Buffer Width (feet)
On-Site Wetlands				
Wetland B	7	5	III	80
Off-Site Wetlands				
Wetland A	6	4	II	150
WL87	7	6	III	150
WL89	8	5	II	100
WL93	7	4	III	80
WL146/148	8	4	III	80

6 Critical Areas Impact Assessment

This section provides a summary of potential impacts to wetlands and to fish and wildlife habitat conservation areas. Mitigation to address the anticipated wetland and buffer impacts will be implemented by on-site mitigation planting, and by a purchase of mitigation credits from the Port of Tacoma Upper Clear Creek Mitigation Bank (Mitigation Bank) that would generate higher-value wetlands off site but within the Mitigation Bank's service area. Table 9 provides a summary of wetland and wetland buffer impacts related to the proposed Project. Proposed wetland and wetland buffer impacts are presented in Figure 9.

Table 9
Proposed Freeman Road Logistics Project Wetland Impacts

Wetland	Wetland Category[1]	Wetland Size (acre)	Permanent Direct (acre)	Permanent Indirect (acre)	On-site Buffer (acre)
Wetland A	II	10.76	0	0	0
Wetland B	III	0.03	0.03	0	0
WL87	III	0.63	0	0.01	0.02
WL89	II	0.13	0	0	0
WL93	III	6.74	0	0.	0
WL146/148	III	0.53	0	0.45	0.97
Total	**NA**	**18.82**	**0.03**	**0.46**	**0.99**

Notes:
1. Source: Hruby 2014

Proposed Project construction activities will not occur within streams or within the approximately 3,447 square feet of the Stream 14 and 15 fish and wildlife habitat conservation buffer areas that projects onto the Main Development Area (Appendix A; Figures 8 and 9).

Indirect impacts are adverse effects on wetlands that occur outside the footprint of direct impacts caused by the placement of dredged or fill material (Ecology et al. 2021). The extent of indirect wetland impact to off-site Wetlands 87 and 146/148 was determined by calculating the areas of the wetlands that are superimposed by the recommended buffers needed to protect those wetland functions, as measured from the outward edge of the development. While the proposed development proposes no impacts resulting from the actual placement of fill material directly into the off-site wetlands, portions of buffers for Wetland 87 and 146/148 would be developed and that would reduce the width of the buffers below local critical area requirements for wetland protection. However, Wetlands 87 and 146/148 will be directly and permanently impacted by construction of the State Route 167 Completion Project, which will be mitigated as part of that project. Therefore, only

mitigation for direct on-site buffer impacts caused by the Freeman Road Logistics Project is proposed as part of this Project (Section 6.1.5).

Buffer averaging is proposed for Wetland 87 buffer that extends into the Main Development Area development footprint. Proposed project construction activities will unavoidably impact approximately 0.02 acre of Wetland 87 buffer area that projects onto Main Development Area parcel 0420205016. The Wetland 87 buffer will be averaged by expanding a 0.03-acre area that is contiguous with and outside of the combined Wetland 93 and Wetland 146/148 buffer area. This expanded buffer area will be enhanced to improve buffer function, as described in Sections 8.4.2.2 and shown in Figure 9.

The Project will not have measurable short-term or long-term impacts on wildlife species. Noise associated with construction activities could result in avoidance behavior by some wildlife species if they are present. However, the Main Development Area is an agricultural and residential area that experiences ongoing human disturbance. Noise levels associate d with operation of the Project after construction are expected to be consistent with current ambient noise levels.

6.1 On-Site and Off-Site Wetland Impacts

6.1.1 On-Site Wetland B Impacts

The Project proposes the total fill (1,218 square feet) of on-site Wetland B, which offers poor water quality, hydrologic, and habitat functions. No practicable alternatives exist that could avoid filling the wetland due to the size, shape, location, and extent of the wetland and the required warehouse and parking capacity, building code requirements, zoning, and other factors supporting the Project purpose and need (Section 2). A detailed description of Project screening criteria and avoidance and minimization measures are provided in Section 7. The Project proposes to provide compensatory mitigation for impacts to Wetland B through purchase of wetland mitigation credits from the Mitigation Bank, which is in the same subbasin as the Main Development Area and proposed impact, pending Port review.

6.1.2 Off-Site Wetland A

The proposed water, sewer, and stormwater line improvements and the Puget Sound Energy gas line work will entirely avoid Wetland A and Wetland A buffer impacts The design has been modified to avoid any temporary or permanent impacts to the Wetland A buffer (Appendix A).

6.1.3 Off-Site Freeman Road East Widening Adjacent to Parcels 0420201104 and 0420201008

Road-widening is expected at the intersection of Freeman Road East and North Levee Road East. The Project proposes to widen Freeman Road west of parcel 0420201008 along parcel 0420201104 from

two 11-foot-wide lanes to two 14-foot-wide lanes. The proposed east edge alignment of Freeman Road will match the current location and fall outside of the 150-foot buffer associated with Wetland A. The roadway improvements will not impact Wetland A or Wetland A buffer. Current design plans (Appendix A) depict a centered road crown, which will result in a minor increase in impervious surfaces (3 feet additional width, 2,100 square feet in area) that will generate runoff directed toward parcel 0420201008. However, the proposed increased flow volumes will be collected and treated by a stormwater detention facility and no stormwater will enter directly into Wetland A or its buffer. These flows are not expected to appreciably alter surface and groundwater hydrology in or around Wetland A (Barghausen 2024).

During the May 2023 site visit, no other wetlands or wetland buffers were present within the road-widening area on parcel 0420201008. Similarly, no wetlands or wetland buffers were identified on parcel 0420201104 to the west of Freeman Road East. Therefore, no critical area impacts will occur because of road-widening. A portion of the road-widening area is within the shoreline zone of the Puyallup River. During Project permitting, two memoranda will be prepared that describe how the proposed work is consistent with shoreline regulations, one for the City of Puyallup and one for the City of Fife.

6.1.4 Off-Site Road-Widening Adjacent to Parcel 0420174032

Widening and improvement of off-site segments of Freeman Road East are anticipated to be required by the City of Puyallup and City of Fife north of 48th Street East, where road-widening may impact a swale along Tribal trust land at parcel 0420174032. This area was assessed during the May 2023 and April 2024 field investigations. No OHWM was observed within the ditch, and this swale area is not a regulated stream.

6.1.5 Off-Site Wetland 87 and Wetland 146/148 Buffer Impacts

In total, approximately 43,035 square feet (0.99 acres) of off-site Wetland 87 and Wetland 146/148 extend onto Main Development Area parcels 0420205016 and 0420174075 and are proposed to be impacted by the Project (Figure 9). The combined area of the buffers has been used to determine the total area of unavoidable on-site buffer impacts that will require compensatory mitigation. Buffer impacts for multiple critical areas within the same location are not double counted (Figure 8).

The consideration of Project impacts to on-site portions of off-site wetland buffers is complicated by the planning for the future use of the WSDOT-owned properties as part of the State Route 167 Completion Project and the mitigation for that project's impacts to wetlands and streams occurring on the WSDOT-owned parcels. Preliminary State Route 167 Completion Project designs indicate that Wetlands 87, 93, and 146/148 and Streams 14 and 15 and all associated buffers will be impacted by State Route 167 construction. The proposed State Route 167 Completion Project mitigation for those unavoidable impacts will be extensive and is planned to include the total regrading of the WSDOT

parcels adjoining to the Main Development Area, including Wetlands 87, 93, and 146/148, relocation of Streams 14 and 15, and wetland re-establishment, rehabilitation, and enhancement to compensate for direct and indirect wetland and wetland buffer impacts within the WSDOT-owned parcels (Appendix D).

Because the Freeman Road Logistics Project will occur prior to the State Route 167 Completion Project, wetland buffer impacts within the Main Development Area parcels are proposed to be mitigated by the Freeman Road Logistics Project. However, because the State Route 167 Completion Project will result in significant permanent, direct disturbance and wetland mitigation within Wetlands 87, 93, and 146/148 and within Streams 14 and 15, no mitigation for indirect wetland impacts caused by the Freeman Road Logistics Project is proposed. It is important to note that the future WSDOT mitigation will be provided with buffers that will be fully located within the WSDOT properties and that these buffers will not extend onto the Main Development Area. The proposed credit purchase from the Mitigation Bank and on-site mitigation planting will sufficiently compensate for the on-site buffers impact that will occur in the short-term prior to the direct, permanent critical area impacts proposed to result from the State Route 167 Completion Project.

6.1.6 Off-Site Wetland 89 Impact

No impact to Wetland 89 or associated wetland buffers are proposed as part of the Freeman Road Logistics Project.

6.1.7 Off-Site Parcels Considered During Design Analysis

According to the Third-Party Second Review Report and Third-Party Third Review Report (Confluence Environmental Group 2024a, 2024b), a wetland located on parcel 0420174707 has been identified in association with a Tribal mitigation project. An earlier project design included utility routing within the existing 78th Avenue East roadway envelope in the vicinity of the wetland and associated buffer. The current project design no longer includes utility or other work along 78th Avenue East, and potential impacts to the Tribal mitigation project have been entirely avoided.

6.2 On-Site Stream Buffer

Off-site Streams 14 and 15 are regulated as Type III streams and protected by 50-foot buffers, per PMC Chapter 21 (City of Puyallup 2024a), which will partially project onto parcels 0420174075 and 0420205016. A 50-foot buffer projected onto the Main Development Area results in an approximately 3,447-square-foot buffer area, with 2,544 square feet on parcel 0420174075 and 933 square feet on parcel 0420205016. The current Project design (Appendix A) fully avoids impacts to the Stream 14 and Stream 15 buffer areas.

6.3 Special Flood Hazard Areas Habitat Assessment

The Main Development Area is located within the 100-year floodplain of the Puyallup River and within a Pierce County designated special flood hazard area. As discussed in Section 3.2, the Puyallup River flows approximately 1,200 feet south of the Main Development Area, south of Levee Road East. The proposed Project includes construction activities within the 100-year floodplain (Appendix A). The Project will be constructed within the footprint of current low-density residential lots and agricultural fields that experience ongoing human use and disturbance from automobiles, livestock, and agricultural activities.

The BFE varies across the Main Development Area between 32 and 33.7 feet NAVD88, and the two warehouse buildings will be elevated so that the finished floor is elevated approximately 1 foot above the BFE. This will place all electrical and other equipment at least 1 foot above the BFE as well. These design features will avoid or minimize potential impacts to the floodplain, reduce the potential for inundation during flood events, and meet Cities of Puyallup and Fife requirements. The orientation of the proposed warehouses will be situated in line with one another (the northern warehouse will be within the hydraulic shadow of the southern building to align with anticipated flood flows through the property when they occur). This design is intended to minimize potential impacts on floodwater velocity.

To construct the proposed structures, a net cut of material will be achieved within the floodplain through proposed final grades and by the use of compensatory storage west of the northern building (Building A). The proposed grading will result in an increase of local floodwater storage volume. Material removed from the floodplain will be located within the same floodplain cross section and perpendicular to the flow. These mitigation measures are anticipated to result in zero net fill and will not cause any rise to the BFE within the floodplain, consistent with PMC 21.07.

The federal habitat assessment guidelines require an analysis of other potential impacts to the floodplain environment. The following includes an analysis of habitat assessment elements per the minimum habitat assessment standards:

- **Project and action area description, maps, and site plans have been provided.** See Preliminary Plan Set in Appendix A.
- **Methods of work are described.** See Preliminary Plan Set in Appendix A.
- **Projects in the Protected Area are designed to inherently avoid detrimental impacts without mitigation.** The Project is located within the footprint of residential and agricultural fields that experience ongoing human use and disturbance. The Project is designed to avoid or minimize potential detrimental impacts through the orientation of the buildings relative to flood flows, stormwater facilities, and removal of soils from other properties within the floodplain.

- **Direct and indirect impacts.** Direct impacts include minor impacts to the floodplain from construction as described in this CAR. Long-term impacts include the presence of structures within the floodplain in an area previously used for residences and agriculture. The long-term environmental benefits from the Project, including improved water quality from runoff, are anticipated to offset any potential short-term impacts from construction and operation of the facility. Indirect impacts from the Project may include improved downstream water quality in the Puyallup River and reductions in nutrient loads to the Puyallup River from runoff and during flood events.
- **Interrelated and interdependent activities.** All development impacts associated with this Project are described in this CAR. No other projects are known that would result in interrelated and interdependent activities.
- **Cumulative impacts.** Cumulative impacts are those that could result in the combination of effects from individual Project actions occurring over time. If left unmitigated, the cumulative or incremental effects of these actions have the potential to result in significant environmental impacts. The Project is located within an area characterized by residences, agricultural fields and associated structures, and industrial buildings, such as warehouses. At the time of publication, there are no nearby projects that are anticipated to contribute to cumulative impacts. However, it is anticipated that future projects in the area would be required to conduct a separate, Project-specific environmental review, as appropriate. It is anticipated that mitigation measures implemented for each project would decrease the potential for cumulative adverse effects on the environment.
- **Other habitat assessment elements include the following:**
  - **Water quantity and quality.** As described previously, the Project is anticipated to result in a net improvement to water quality from runoff and during flood events due to the construction of stormwater facilities. During construction, stormwater control measures will be implemented to avoid or minimize potential short-term construction impacts on water quality to be shown in a Stormwater Pollution Prevention Plan and Temporary Erosion and Soil Control Plan. A Stormwater Site Plan will also be prepared, describing the stormwater control best management practices (BMPs) incorporated into the Project to meet the requirements of the Cities of Puyallup and Fife stormwater regulations. The Project will have no impact on water quantity.
  - **Flood velocities and volumes.** As described previously, the Project has been designed to accommodate flood velocities through orientation of the structures (with the north warehouse designed to be within the hydraulic shadow of south warehouse) and to align them with floodwaters. The Project will not create any rapid water runoff conditions and therefore will not impact flood flows downstream. The Project will have a negligible impact on flood volumes.

  - **Flood storage capacity.** Earthwork cuts and fills will be balanced at the site to the extent possible. The construction of improvements at the proposed stormwater facilities will provide no net loss to flood storage capacity.
  - **Riparian vegetation.** The Project is located over 1,200 feet from the Puyallup River and associated riparian buffers. No riparian vegetation will be impacted by the Project.
  - **Measures to preserve habitat forming processes.** No in-water work is proposed, and no impacts to habitat forming processes will occur from the Project; therefore, no measures to preserve habitat forming processes are proposed.
  - **Refuge from higher velocity floodwaters is provided.** The presence of the structures within the floodplain may provide limited refuge from higher velocity floodwaters. No additional measures are proposed.
  - **Spawning substrate is provided or protected.** No in-water work or work in the vicinity of salmonid spawning habitat is proposed, and no impacts to spawning substrate will occur from the Project; therefore, no spawning substrate needs to be provided by the Project.
- **No adverse effects from habitat isolation, bank armoring, channel straightening, construction effects (transport of sediment from the work area, noise, etc.), or direct effects.** No habitat isolation, bank armoring, or channel straightening is proposed as part of the Project. To avoid or minimize potential construction effects from the Project, stormwater control measures will be implemented to avoid or minimize potential construction impacts on water quality and will be shown in the Stormwater Pollution Prevention Plan and Temporary Erosion and Soil Control Plan. As described above, a Stormwater Site Plan will also be prepared describing the stormwater control BMPs incorporated into the Project to meet the requirements of the Cites of Puyallup and Fife stormwater regulations. Overall, the long-term environmental benefits from the Project, including improved water quality from runoff, are anticipated to offset any potential short-term impacts from construction and operation of the facility.

For the reasons stated above, the proposed Project may affect, but is not likely to adversely affect, listed fish NMFS species, as evaluated per the NMFS Biological Opinion for the National Flood Insurance Program (NMFS 2008), or listed USFWS species.

7 Site Selection Screening and Alternatives Analysis

7.1 Site Selection Screening Criteria

To meet the Project purpose and need described in Section 2), site selection criteria were developed to evaluate potential alternatives. The primary criterion is a site large enough to accommodate the stated purpose and need for development of a 505,000-square-foot commercial warehouse with employee parking, truck loading bays, truck parking and area for truck maneuvering within proximity to the Port and transportation infrastructure linkages. This area was selected in accordance with market demand for this product (i.e., very large commercial warehouse vacancy is low) and Pierce County's Comprehensive Plan.

In order to accommodate such a development, the property must be between 20 and 30 acres to accommodate the 505,000-square-foot warehouse building capacity and car and trailer parking to meet local codes for setbacks, off-street parking, landscaping and screening, truck movements, fire access, and trailer parking, and it must be zoned LM/W. Other site requirements include the presence of well-developed infrastructure (e.g., road network, utility systems) and a highly qualified regional labor pool to support the land use. The site must also be within 5 miles of the Port and I-5 to support efficient movement of goods with easy access via State Route 167 Completion Project or the Canyon Road Regional Connection Project. This parameter is important due to the nature of the Project. Logistics centers are intended to efficiently receive and distribute goods, and the Project location will support the applicant's intention to minimize or avoid issues with traffic concurrency and impacts to local road conditions from the added truck traffic. In addition, the site should make efficient use of lands designated for LM/W development within the City of Puyallup Freeman Road Comprehensive Plan Map Amendment and FRO, maximize the use of existing infrastructure, and provide jobs in the growing Cities of Puyallup and Fife and greater Pierce County area.

The Project's need to impact wetlands and critical area buffers is related to the location of wetlands and critical area buffers on the Main Development Area, as well as requirements for warehouse capacity, existing roads, access roads, and other infrastructure improvements required to support the proposed Project. Placement of material into wetlands and critical area buffers is unavoidable to facilitate the expansion and improvement of existing roadways and sidewalks; installation of stormwater, sewer and water utilities; and construction of the warehouses and associated parking and vehicle movement areas, including emergency vehicle ingress and egress.

Three sets of screening criteria were selected to evaluate potential alternatives to the proposed Project:

1. Whether or not the alternative would meet the stated Project purpose and need
2. The extent to which the alternative would avoid and minimize impacts to regulated wetlands and other waters

3. The extent to which the alternative is practicable for use for typical warehouse and/or distribution users

Each criterion is further described in the following sections.

7.2 Achievement of Project Purpose and Need

Alternatives were analyzed based on their ability to achieve the stated purpose and need for development of 500,000-square-foot warehouse capacity with employee parking, truck loading bays, and truck parking within 5 miles of the Port and I-5.

In order to achieve this purpose and need, alternative sites must meet the following screening criteria:

- Be zoned for LM/W use, or Employment Center (EC), which is the equivalent zoning designation in use by Pierce County.
- Be within 5 miles of the Port and I-5 with easy access via State Route 167 Completion Project or the Canyon Road Regional Connection Project.
- Be located in an area with a well-developed utility infrastructure, or where necessary improvements could be reasonably afforded.
- Be located in an area that can provide a highly qualified regional labor pool.
- Be able to maximize the use of lands zoned as LM/W of EC.
- Address the regional shortage of 500,000-square-foot warehouse capacity.
- Support traded-sector investments that create high-wage jobs and tax base in the City of Pullup or another portion of Pierce County.

7.3 Avoidance and Minimization of Impacts

Alternatives were also analyzed based on the capacity for a viable site design to avoid and minimize impacts to any wetlands that specifically provide high ecological and societal functions. Wetlands with any of the following characteristics were considered priorities for avoidance and impact minimization:

- Wetland areas with a “high” potential and associated “high” value scores, as determined from the Washington State Wetlands Rating System – Western Washington: 2014 Update (Hruby 2014)
- Palustrine forested or scrub-shrub wetlands; mitigation for these wetlands entails a higher temporal loss of functions and values than occurs for emergent wetlands
- Riverine or slope wetlands, which are more difficult to replace in-kind than depressional wetlands
- Wetlands connected to streams or other waterways that provide habitat to native fish, ESA-listed fish, or other ESA species

- Wetlands containing special characteristics (Hruby 2014)
- Wetlands characterized by predominately native vegetation species
- Wetlands designated as locally "significant" in Pierce County code or plans
- Wetlands that provide connectivity between, or provide buffer functions to, other valuable upland or wetland habitats, either on or off site
- Any wetlands of high conservation value (WDNR 2024)
- Any designated Priority Habitat Area (WDFW 2024a)

Agriculturally degraded or artificially created wetlands were considered more easily replaced through mitigation with no issues associated with temporal loss. In situations where the quality or origin of a wetland or other water was unknown, avoidance and minimization were kept as the higher priority.

7.4 Practicability

Alternatives were analyzed based on their practicability for use by typical warehouse and logistical users. Factors considered in assessing practicability to the end user included the following general and site-specific criteria.

7.4.1 General Practicability Criteria:

- Short timeline to facility construction, with sites available for construction within 12 months being most practicable
- Readily available for warehouse development (e.g., not earmarked or restricted by designated use/zoning)
- Geometry of building shapes (i.e., rectangular, irregular, square): rectangular building shapes generally preferred for efficient interior layout
- Topography of the site (e.g., flat, rolling, sloped) and presence of natural resource constraints (e.g., wetlands or streams): flat sites without wetlands or stream constraints are generally preferred due to a limited ability to incorporate changes in finished floor elevations in warehouse facilities

7.4.2 Site-Specific Practicability Criteria

- Percent building coverage of site: building coverage of between 30% and 50% is targeted for warehouse/distribution facilities depending on the size of the lot
- Ratio of parking spaces to site size and resultant number of parking spaces: minimum "market" parking requirements of 1.0 employee parking space per 3,000 square feet of building and an equal number of truck parking stalls as truck bays are desired by warehouse/distribution facilities

- Capacity of site to support loading, service, and storage requirements of typical warehouse/distribution facility users: warehouse/distribution typically requires access by large trucks

7.5 Alternatives Analysis

Four potential alternatives were identified for the proposed warehouse and logistics development including a "no action" option. Each of these alternatives is discussed in the following sections.

7.5.1 Alternative 1: No Action

Under this alternative, the proposed Main Development Area would not be developed for warehouse and logistical uses and would continue to exist as vacant and disused grassy lots. The Project purpose and need would not be achieved with this alternative.

7.5.2 Alternative 2: Off-Site Alternatives

Under this alternative, a different site or sites would be used for the proposed Project. Potential alternative sites were evaluated through an informal parcel analysis completed by Vector Development Company using the purpose and need criteria provided in Section 2 of this CAR. Parcels were also reviewed to select potential sites that were not encumbered or characterized by any of the following:

- Ownership by a city or county division unless known to be surplus and for sale
- Ownership by a land trust or private club/organization with a mission to protect or preserve the land as open space or for public or private recreation
- Special tax status granted by enrollment in a state authorized program for open space, agriculture, or timber land

No qualifying parcels that were for sale or may potentially be for sale were identified that met the listed criteria and the purpose and need criteria.

7.5.3 Alternative 3: North-South Building Layout No 1

Alternative 3 is an on-site design that involves developing the proposed Freeman Road Logistics Main Development Area using a north-south building layout. Under this alternative, the build-out design would be adjusted so that the footprint of the northern building and associated paved parking areas would be decreased to avoid all impacts to on-site Wetland B and Wetland B buffers. The footprint would also be reduced to avoid impacts to buffers from off-site Streams 14 and 15 and Wetland 93.

Reducing the footprint to avoid impacts to buffers from off-site Streams 14 and 15 and from off-site Wetlands 87, 93 and 146/148 is feasible. However, total elimination of impacts to Wetland B and its

buffer and the off-site critical area buffers would require reducing the size of the north building footprint by approximately 119,955 square feet in order to retain required Freeman Road East improvements and buffer setbacks under the FRO, achieve necessary truck parking and maneuvering space, and provide required emergency vehicle ingress and egress. Alternative 3 consists of a north building footprint of approximately 119,955 square feet and a south building footprint of approximately 256,102 square feet, resulting in a total Project warehouse capacity of an approximate 376,057-square-foot warehouse capacity, which is well below the minimum 500,000-square-foot warehouse capacity threshold required to meet the applicant's purpose and need.

7.5.4 Alternative 4: North-South Building Layout No 2

Alternative 4 is an on-site design that involves developing the proposed Freeman Road Logistics Main Development Area using a north-south building layout and total fill of Wetland B, buffer width averaging for the on-site portion of Wetland 87 buffer, and partial development of the on-site portion of Wetland 146/148 buffer. The on-site portion of Stream 14 and 15 buffer areas is fully avoided. Under this alternative, the build-out design of the northern building would use the Main Development Area while retaining required Freeman Road East improvements and buffer setbacks under the FRO, achieving necessary truck parking and maneuvering space, and providing required emergency ingress and egress.

Alternative 4 would consist of a north building footprint of approximately 234,901 square feet and a south building footprint of approximately 256,102 square feet, resulting in a total Project warehouse capacity of 505,436 square feet, which is above the minimum 500,000-square-foot warehouse capacity threshold required to meet the applicant's purpose and need. Additionally, the Alternative 4 layout would meet the Project purpose by making efficient use of lands designated for LM/W uses, maximizing the use of existing infrastructure, providing additional transportation and other infrastructure improvements, and providing high-wage jobs in the growing City of Puyallup and Pierce County areas within 5 miles of the Port and I-5. The north-south building layout is expected to address important market demand for very large commercial warehouses and would provide one parking space for every 3,000 square feet of building, providing the parking space ratio needed for warehouse/distribution facilities of this kind.

Alternative 4 would directly impact 1,218 square feet of Wetland B, a Category III depressional wetland that contains highly degraded PEM habitat. Additionally, Alternative 4 would directly impact 42,067 square feet of Wetland 146/148 buffer and 968 square feet of Wetland 87 buffer and fully avoid impacts to the Streams 14 and 15 buffers occurring on site (Appendix A; Figure 8 and 9). The Wetland 146/148 buffer impacts (42,067 square feet) will be mitigated by purchase of credits from the Mitigation Bank. Wetland 87 buffer impacted by construction (968 square feet) would be averaged by increasing the buffer area by 968 square feet of currently degraded buffer area contiguous with the Wetland 93 and Wetland 146/148 buffer areas The current condition of Wetland B

and the on-site portions of the wetland buffers is poor, with low native species diversity and low to moderate functions and values. Off-site wetlands and streams will also be relocated as part of the State Route 167 Completion Project occurring on WSDOT-owned parcels. Functions of on-site wetlands and buffers would be offset by on-site buffer mitigation enhancement and purchase of mitigation credits at the Mitigation Bank. This alternative would achieve a net benefit of wetland function by generating much higher-value wetlands at the Mitigation Bank Site and for remaining on-site buffers.

7.6 Site Selection Screening and Alternatives Analysis Conclusions

Based on the alternatives analysis, Alternative 4, the north-south building layout, with on-site buffer enhancement and purchase of off-site compensatory wetland mitigation credits from the Mitigation Bank, would best meet the Project purpose and need. It would meet the minimum of 500,000 square feet of warehouse capacity within 5 miles of the Port and I-5 via State Route 167. Alternative 3 would not achieve a minimum 500,0000-square-foot warehouse capacity, would not maximize the appropriately zoned use of the property. Alternative 4 would achieve a net improvement in habitat quality through wetland buffer enhancement and the purchase of 0.079 wetland credit at the Mitigation Bank Site by generating higher-value wetlands off-site but within the Mitigation Bank's service area.

8 Avoidance, Minimization, and Mitigation Measures

The results of the critical area assessment identified on-site Wetland B (Category III), five off-site wetlands (Wetland A [Category II], Wetland 87 [Category III], Wetland 89 [Category II], Wetland 93 [Category III], and Wetland 146/148 [Category III]), and two off-site streams (Streams 14 and 15) within the Study Area. The Project has been designed to avoid and minimize impacts to critical areas and their buffers to the maximum extent possible while also satisfying design criteria for the development and City of Puyallup and City of Fife building and zoning requirements. The Project includes unavoidable fill impacts to on-site Wetland B (1,218 square feet), buffer width averaging for on-site Wetland 87 buffer, and to on-site portions of off-site Wetland 146/148 buffer (42,067 square feet), which provide poor water quality and hydrologic and habitat functions. The Project proposes to offset the wetland fill and buffer impacts with on-site buffer enhancement and by purchasing wetland credits from the nearby Mitigation Bank that would generate higher-value wetlands off site but within the Mitigation Bank's service area.

8.1 Mitigation Sequencing

The proposed Project requires the necessary and unavoidable fill of on-site Wetland B, located centrally on parcel 0420174075, and the on-site portions of critical area buffers located on parcels 042174075 and 0420205016. Per PMC 21.06.610, projects should first attempt to avoid impacts all together by not taking certain actions. If actions cannot be eliminated, impacts should be minimized by restraining the magnitude of an action, using different technology, or taking steps to reduce impacts. For impacts that cannot be avoided or minimized, compensation or rectification for the impact should be provided by replacing, enhancing, or providing substitute resources or environments, followed by monitoring and reduction of the impact over time. Mitigation sequencing, outlined under PMC 21.06.210(84), for impacts to critical areas, is as follows:

1. Avoiding an impact altogether by not taking a certain action or parts of actions
2. Minimizing impacts by limiting the degree or magnitude of an action and its implementation
3. Rectifying impacts by repairing, rehabilitating, or restoring the affected environment
4. Reducing or eliminating an impact over time by preservation and maintenance operations during the life of the action
5. Compensating for an impact by replacing or providing substitute resources or environments
6. Monitoring the mitigation and taking remedial action when necessary

As discussed in Section 7, no practicable alternatives could avoid on-site Wetland B and the on-site portions of the off-site critical area buffer impacts and still fulfill the Project purpose and need due to the size, shape, location, and extent of the wetland and the required warehouse and parking capacity, building code requirements, zoning, and other factors. Project avoidance, minimization, and mitigation measures included site selection screening criteria (Section 7.1), alternatives analysis

(Section 7.5), and avoidance and design and construction measures (Sections 8.2 and 8.3, respectively). The Project proposes to provide compensatory mitigation for all impacts to Wetland B and to the on-site potions of off-site critical area buffers by purchase of wetland mitigation credits from the nearby Mitigation Bank and on-site mitigation plantings.

8.2 Avoidance and Minimization Measures

8.2.1 Design Measures

The Project includes unavoidable permanent adverse impacts to all of Wetland B located on parcel 0420174075, unavoidable partial impacts to the on-site portions of off-site Wetland 146/148 buffers, and buffer width averaging for the on-site portion of Wetland 87 buffer located on parcels 0420174075 and 0420205016 within the Main Development Area. The Project has been designed to first avoid and then minimize and offset impacts to both on-site and off-site critical areas and critical area buffers to the extent practicable while also satisfying the City of Puyallup and City of Fife building and zoning code requirements and fulfilling the criteria of the Project's stated purpose and need.

An earlier project design included parking space and associated impervious areas that overlapped with the Stream 14/15 buffers that extend onto the southeast corner of Main Development Area parcel 0420174075 and the northeast corner of Main Development Area parcel 0420205016. The current design has been reconfigured to avoid any impact to the Stream 14/15 buffer areas (Appendix A). Additionally, the current design plan has minimized impacts to Wetland 87 and Wetland 146/148 buffers that project on site to the maximum practicable extent possible while still meeting PMC parking space and emergency access requirements. Unavoidable wetland buffer impacts will be mitigated by purchase of wetland mitigation credits from the nearby Mitigation Bank and on-site buffer enhancement. Further discussion of avoidance and minimization is included in Section 7.

8.2.2 Construction Measures and Best Management Practices

Other measures to avoid and minimize impacts include the implementation of the following BMPs during construction:

- All work will be performed according to the requirements and conditions of the Project permits.
- Impacts to off-site wetlands, off-site streams, and on-site stream and wetland buffers will be minimized during construction through the use of temporary erosion and sediment control BMPs. The contractor will prepare and implement a Temporary Erosion and Sediment Control Plan and a Spill Prevention, Control, and Countermeasures Plan.

- All wash water and concrete-laden water associated with construction will be treated to meet State of Washington surface water quality standards (Chapter 173-201A Washington Administrative Code) prior to discharge into surface waterbodies. Concrete-laden water may also be removed from the site.
- All concrete will be poured in dry conditions, or within confined areas not connected to surface waters, and shall be sufficiently cured prior to contact with surface waters.
- Excess or waste materials will not be disposed of or abandoned within the wetland boundary or waterward of the OHWM or allowed to enter waters of the State.
- No petroleum products, chemicals, or other toxic or deleterious materials will be allowed to enter the wetland or surface waters.
- The contractor will be required to properly maintain construction equipment and vehicles to prevent them from leaking fuel or lubricants; if there is evidence of leakage, the further use of such equipment will be suspended until the deficiency has been corrected.
- The Project will be constructed consistent with the stormwater management design criteria outlined in the Ecology *Stormwater Management Manual for Western Washington* (2019) and the Pierce County *Stormwater Management and Site Development Manual* (2021) to reduce and control surface runoff.

8.3 General Goals of Compensatory Mitigation

The general goals of the critical area and critical area buffer compensatory mitigation include the following:

- Ensure no net loss of critical areas and their buffers as a result of the Project.
- Provide on-site buffer enhancement to compensate for critical area buffer impacts.
- Offset direct critical area and critical area buffer impacts through the purchase of mitigation bank credits.

8.4 Compensatory Mitigation

8.4.1 Wetlands and Critical Area Buffers

Under PMC and state and federal regulations, mitigation is required for unavoidable permanent impacts to 1,218 square feet (0.03 acre) of Category III wetlands, and 42,067 square feet (0.97 acre) of total combined unavoidable permanent impacts to the on-site portion of off-site critical area buffers (Figure 9). The mitigation will also include averaging of a 968-square-foot (0.02-acre) portion of the Wetland 87 buffer that extends onto the Main Development Area.

The project proposes on-site buffer enhancement by planting native vegetation on approximately 0.59 acre of the on-site buffer area. An additional 0.03 acre of the buffer area will be expanded by buffer averaging and will be enhanced by planting native vegetation. On-site mitigation for all

adverse unavoidable impacts is not possible because of City of Puyallup design, building, and zoning code requirements and the criteria of the Project's stated purpose and need. Direct impacts to Wetland B (0.03 acre) and on-site critical area Wetland 146/148 buffer impacts not compensated on-site by enhancement (0.38 acre) will be offset through the purchase of mitigation credits from the Mitigation Bank with a service area that includes the Project location. The mitigation purchase will satisfy the no net loss provision required by federal and state executive orders for the protection of wetlands (Presidential Executive Order 11990 and Washington State Executive Order 90-04) and will also fulfill PMC mitigation requirements. Table 10 provides a summary of on-site and off-site mitigation actions provided by the project to adequately compensate for all unavoidable critical area impacts.

Table 10
Summary of Anticipated of Critical Area Impacts and Mitigation Actions

Resource	Impact Area (acres)	Mitigations Type (acres)	Mitigation Ratio	Mitigation Area/Credits
Direct Impacts				
Wetland B	0.03	Mitigation Bank Credit Purchase	1:1	0.03
Indirect Impacts				
Wetland 146/148	0.45	NA[1]	NA[1]	NA[1]
Wetland 87	0.01	NA[1]	NA[1]	NA[1]
Buffer Impacts;				
Wetland 146/148	0.97	On-site Enhancement (0.59)	1:1	0.59
		Mitigation Bank Credit Purchase (0.38)	0.2:1	0.076
Wetland 87	0.02	Buffer Averaging (0.03)[2]	1:1	0.03

Note:

1. Because future WSDOT mitigation areas resulting from the WSDOT State Route 167 Completion Project will be provided with protective buffers located fully within the WSDOT parcels, the Project does not propose additional mitigation for indirect impacts to Wetland 87 and 146/148.
2. Buffer areas "averaged in" will also be enhanced by native planting.

The Project proposes to purchase mitigation credits from the Mitigation Bank, which is a bank in Pierce County approved by the Interagency Review Team to sell credits for wetland and other critical area impacts. Wetland B and the Wetland 87 and Wetland 146/148 buffers that extend onto the Main Development Area are currently degraded and have been highly impacted by previous land use at the site. The existing buffer area provides low water quality, hydrology, and habitat functions to off-site wetlands due to compacted soils, the presence of invasive species, and lack of canopy layer and shading. On-site buffer enhancement will improve wetland buffer functions and values through native plant installation (0.59 acre). The remainder of Wetland 146/148 buffer impacts will be mitigated through the purchase of credits from the Mitigation Bank. The goal of the Mitigation Bank

is to protect, re-establish, and rehabilitate high-quality riverine Category I wetland habitat and create a mosaic of forested, scrub-shrub, emergent and riverine wetland conditions and buffers in the same watershed. Compensation at the Mitigation Bank and the on-site buffer enhancement area will be preserved in perpetuity.

Guidance from Ecology and the U.S. Army Corps of Engineers (Ecology and USACE 2013) was used to determine the number of bank credits that need to be purchased using the ratios in Table 11. Mitigation bank credit ratios are consistent with the Mitigation Bank Instrument (Port 2023). Direct wetland impacts are required to be mitigated at a 1:1 ratio. Critical area buffer impacts are mitigated on a case-by-case basis per local jurisdictions under the Mitigation Bank Instrument (Port 2023). A ratio of 0.2:1 is consistent with the instrument and is proposed because the existing on-site critical area buffer is highly degraded agricultural and residential land and has poor hydrologic, water quality, and habitat functions. Additionally, the buffers that extend on site are off-site wetlands that will soon be impacted by the State Route 167 Completion Project occurring on WSDOT-owned parcels (Wetlands 87, 93, and 146/148), which will be completely regraded with new protective buffers that will be located entirely within the WSDOT-owned properties and will not extend onto the Main Development Area. Similarly, no mitigation is proposed for indirect impacts to off-site wetlands because of the regrading plan associated with the State Route 167 Completion Project.

Table 11
Proposed Mitigation Debit Ratios in Use at Mitigation Bank

Resource Impact	Bank Credits : Impact Acreage
Wetland, Category III	1:1
Critical Area Buffers	0.2:1

Source: Ecology and USACE 2013

The Project proposes purchase of 0.079 credit as detailed in Table 12. Credits will be purchased following approval of the mitigation plan, as presented in this CAR, by the City of Puyallup and Ecology.

Table 12
Scenario 2 (0.2:1 Ratio): Critical Area Impacts and Proposed Credit Purchase

Critical Area Impact	Bank Credits : Impact Acreage	Impact Acreage	Proposed Credit Purchase
Weland B, Category III direct impacts	1:1	0.03	0.03 credit
Wetland 87, Category III indirect impacts	1:1	0.01	0 credits[1]

Critical Area Impact	Bank Credits : Impact Acreage	Impact Acreage	Proposed Credit Purchase
Wetland 146/148, Category III indirect impacts	1:1	0.45	0 credits[1]
Critical Area Buffers	0.2:1	0.38	0.076 credits
		Total Credit Purchase	**0.079 credits**

Note:

1. Because future WSDOT mitigation areas resulting from the WSDOT State Route 167 Completion Project will be provided with protective buffers located fully within the WSDOT parcels, the Project does not propose additional mitigation for indirect impacts to off-site Wetlands 87 and 146/148.

Vector will enter into a credit purchase agreement with the Port of Tacoma and provide proof of sale documentation to the City of Puyallup and to Ecology.

8.4.2 Functional Benefits of the Mitigation

8.4.2.1 Mitigation for Permanent Wetland Impacts

Compensatory mitigation for permanent direct impacts to Wetland B (0.03 acre) will be achieved by purchase of credits from the Mitigation Bank prior to construction activities. The credit purchase is intended to address the specific loss of wetland and wetland buffer functions at the impact site and replace these functions at a nearby Mitigation Bank, which is located within the same basin of the proposed impacts. The Project is located approximately 5 miles to the east of the Mitigation Bank and is within the Mitigation Bank service area. This Mitigation Bank encompasses approximately 28.64 acres located at 3714 and 4014 Gay Road East, Tacoma, Washington 98443, 36 portions of Pierce County parcels 0320141001 and 0320141086 in Sections 13 and 14 of 37 Township 20 North, Range 3 East, Willamette Meridian. The bank has been constructed and is successfully re-establishing, rehabilitating, and enhancing wetland functions across the site (Mitigation Bank 2020).

The proposed credit purchase is intended to further improve the ecological functions within the Puyallup River watershed and support the following ecological goals of the Mitigation Bank:

- Restore ecological processes and structures including, stream, wetland, and floodplain connections.
- Realign stream channels, re-establish floodplain connectivity, and rehabilitate riverine wetlands and off-channel ponds.
- Establish diverse hydrogeomorphic conditions and vegetation zones, including emergent, scrub-shrub, and forested wetlands.
- Re-establish and rehabilitate wetland habitat to pre-impact conditions to the maximum extent possible.
- Maximize wetland area and functions.

- Establish multiple native wetland plant communities and functional native vegetated upland habitat.
- Protect existing upland forested areas to the extent possible and provide additional forested upland area.
- Restore fish and wildlife habitat, structure, and function.
- Manage invasive and non-native species.

8.4.2.2 Mitigation for Buffer Impacts

Compensatory mitigation for permanent impacts to Wetland 146/148 buffer (0.97 acre) will be achieved by on-site buffer enhancement following construction activities by restoring approximately 0.59 acre of currently degraded Wetland 93 and Wetland 146/148 buffer areas. This buffer enhancement will include a layer of planting soil and mulch placed in the restored buffer area along with installation of native trees, shrubs, and groundcover species. Compensatory mitigation for the remaining 0.38 acre of Wetland 146/148 buffer impacts will be provided by purchasing credits from the Mitigation Bank. Section 8.4.2.1 describes the functional lift provided by the Mitigation Bank.

On-site buffer enhancement of an expanded buffer area will be provided for the reduced portion of Wetland 87 buffer (0.02 acre). Buffer enhancement will be achieved by restoring currently degraded buffer area contiguous with the Wetland 93 and Wetland 146/148 buffer areas. This buffer expansion will restore 0.03 acre and include a layer of planting soil and mulch placed in the restored buffer area along with installation of native trees, shrubs, and groundcover species which will significantly improve habitat conditions currently existing within the existing buffer area.

PMC 21.06.930 allows for buffer averaging if following criteria are met:

- The total area contained in the buffer area after averaging is no less than that which would be contained within the standard buffer;
- The buffer averaging does not reduce the functions or values of the wetland
- The portion of the buffer subject to buffer averaging is less than 20% of the total buffer length on a project site; provided, that:
  - The director may waive the 20% limitation when there are specific topographic conditions adjacent to the wetland that render portions of the buffer nonessential or ineffective in protecting wetland functions, and
  - The director finds that the averaging occurs parallel to the existing wetland boundary;
- The wetland contains variations in sensitivity due to existing physical characteristics or the character of the buffer varies in slope, soils, or vegetation;
- The buffer width for Category I and II wetlands is not reduced by more than 25% of the standard width; and
- The buffer width of a Category III or IV wetland with moderate habitat functions (six to seven points for habitat) may be reduced by no more than 33% of the standard buffer width. The

buffer width of a Category III or IV wetland with low habitat functions (less than six points for habitat) may be reduced to 35 feet.

- In any case where a reduced buffer width is applied consistent with the subsections above, the buffer shall be composed of a dense native plant community; if the buffer area contains over 20% coverage by invasive plant species, the applicant shall provide a vegetation management plan to remove those invasive plants, supplement the buffer area with native trees and shrubs and monitor the buffer area for a period of no less than three years to ensure eradication of invasive plants and establishment of new native plants from the buffer area. The enhanced functions must be documented to the satisfaction of the director through a functions and values analysis prepared by a qualified professional.

The proposed buffer averaging meets all the required criteria. The total area contained in the buffer area after averaging will be greater than that which would be contained in the standard buffer (net increase of 0.01 acre). The buffer averaging will increase the functions and values of the wetland by providing increased plant species diversity and a more complex assemblage of habitat features for use by wildlife adjacent to the off-site wetlands. The portion of the buffer averaging is greater than 20% of the total buffer length on the project site; however, the location averaging will occur parallel to the existing Wetland 87 boundary and may be waived. The character of the Wetland 87 buffer varies in vegetation and will be improved by installing native plants. Wetland 87 is a Category III wetland with a habitat score of 6 and will not be reduced by more than 33% of the standard buffer width (the reduced buffer width is 137 feet, which is a reduction of about 9% of the 150-foot-wide standard buffer width). All buffer areas will be planted with a dense native plant community. Invasive species coverage in the buffer area is currently less than 20%, but the replanted buffer area will be monitored for three years to ensure eradication of invasive species and verify the establishment of the new native plantings.

9 Proposed On-Site Mitigation Planting Plan

9.1 General Description of On-Site Mitigation Planting

The on-site mitigation planting plan addresses the specific loss of wetland buffer functions at the impact site and replaces these functions within the Project area. The general mitigation plan is to enhance currently degraded wetland buffer areas by providing dense native plant to restore and improve species diversity and habitat functions. This will mitigate for unavoidable impacts to wetland buffers due to the extent practicable while also satisfying the City of Puyallup and City of Fife building and zoning code requirements and fulfilling the criteria of the Project's stated purpose and need.

On-site wetland buffer mitigation activities will consist of buffer enhancement, including clearing to prepare the site and remove any invasive plant species, placing a layer of panting soil (952 cubic yards [CY]) and mulch 238 CY) in the in the buffer area to be enhanced, and planting approximately 62 trees, 278 shrubs, and approximately 1,564 ground cover plants. Native plant species to be installed within the created wetland and wetland buffer are listed in the planning schedule in Appendix E. Once completed, a temporary irrigation system will be installed within the restored wetland buffer. Additionally, fencing will be installed around the perimeter of the wetland buffer to protect the restoration area.

9.2 Soil Preparation

The on-site wetland buffer mitigation area will be cleared to the final grade of the proposed mitigation site. The contractor will amend the existing native soils to establish suitable soil conditions to support on-site native plantings.

9.3 Vegetation

Plantings within the on-site wetland buffer mitigation area will be installed to establish a mix of emergent, scrub-shrub, and forest upland communities. The goal of the planting plan is to mimic natural conditions. Plantings will be installed in clusters and grouped and spaced to replicate a natural pattern of plant dispersal and enhance habitat for a variety of wildlife.

Existing vegetation in the wetland buffer mitigation area will be removed, including invasive species such as Himalayan blackberry and reed canary grass prior to the installation of the plantings.

Following construction, invasive species will be controlled in accordance with the monitoring program. Mitigation site management activities are described in Section 9.9.

9.4 Construction and Planting Schedules

Construction plans for the mitigation are included in Appendix A as follows:

- Sheet 1 of 5: Clearing Plan
- Sheet 2 of 5: Soil Preparation
- Sheet 3 of 5: Planting Plan (1 of 2)
- Sheet 4 of 5: Planting Plan (2 of 2)
- Sheet 5 of 5: Planting Schedule and Details

9.5 General Mitigation Goals

The goals for the on-site wetland buffer mitigation include the following:

- Establish native tree, shrub, and/or groundcover vegetation communities in the wetland buffer areas
- Control invasive species.

9.6 Objectives and Standards of Success for Wetland Mitigation

Objective 1: Plant communities will be restored by installing native trees, shrubs, and emergent species.

- **Performance Standard 1:** Average survival of planted trees will be at least 90% at the end of Year 1, at least 80% at the end of Year 2, and 70% by the end of Year 3.
- **Performance Standard 3:** Invasive, non-native trees and shrubs are maintained at levels below 15% total cover within planted wetland buffer areas in all years.

9.7 Monitoring Plan

To ensure success of the mitigation plan, monitoring will be completed to determine the success of the wetland mitigation. Monitoring will occur for a minimum of 3 years following completion of construction. An as-built report will be completed after plant installation and submitted to the City of Bonney Lake for use as a reference document during the monitoring period.

Monitoring of the planted wetland and buffer areas will occur near the end of the peak growing season in summer or early fall in each of the monitoring years after installation. Monitoring reports will be submitted to the City of Puyallup each monitoring year. Data on the number and species of plants (as a measure of diversity), survival rates, canopy (aerial percentage) cover, stem density, and plant heights will be measured and recorded during each monitoring period. Permanent sample plots and photo stations will also be established at control points to document existing conditions during each monitoring period.

Plant community success within the planting area will be evaluated during the monitoring periods. In an effort to assess plant diversity, the assessment will include installed plant survival and vegetation percent cover.

Invasive trees and shrubs will be removed where present in the wetland and wetland buffers. Following planting, all enhanced buffer areas will have less than 15% total cover of invasive trees and shrubs each monitoring year.

9.8 Contingency Plan

If the mitigation and restoration areas fail to meet their performance standards, a contingency plan(s) will be developed. Contingency plans may include, but are not limited to, the following:

- Plant substitutions of type, species, size, quantity, and/or location
- Additional plant installation to address survival or cover problems
- Weeding and additional plant installation to address invasive weed cover
- Regrading or modifications to hydrologic sources to address problems with wetland hydrology
- Erosion control
- If purple loosestrife or knotweeds (Japanese, giant, Himalayan, or related hybrid) are identified on site, weed control will be immediately implemented
- Providing fencing or plant guards around plants to prevent animal damage
- Providing fencing to prevent vandalism or other damage caused by humans
- Hand watering, irrigation, or other watering methods may be employed if planted species within the mitigation or restoration sites appear to be dying from drought, especially in the upland buffers

A contingency plan will be implemented on an as-needed basis. Contingency plans will be developed for review and approval by regulatory agencies as appropriate. In addition, implemented contingency plans will be described in the year-end monitoring report.

9.9 Mitigation Site Management

The mitigation area will be actively managed for a minimum of 3 years following completion of construction. This will include at least one management or maintenance visit per year for a minimum of 3 years following implementation of the mitigation plan. Site management visits will occur during the growing season in May through July. The following tasks will be completed during these visits:

- During Years 1, 2, and 3, the planting area will be weeded by hand to remove any new shoots of non-native and/or invasive vegetation within a 2-foot radius of each installed plant.

- During Year 1, installed plantings in the wetland buffer area must receive a minimum of one inch of water each week from June to September from the temporary irrigation system or natural rainfall.
- During the Year 2 management visit, tree stakes shall be removed.
- Additional management visits may also be required to respond to other monitoring recommendations.

Following completion of the prescribed monitoring and site management periods, the mitigation sites will be protected from development or other alteration in perpetuity.

10 References

Barghausen (Barghausen Engineering), 2024. Personal communication from Jason McArdel, PE, Senior Civil Project Manager, with Jakob Rowny, Anchor QEA.

City of Fife, 2024a. "Fife Municipal Code." Accessed May 6, 2024. Available at: https://www.codepublishing.com/WA/Fife/.

City of Fife, 2024b. Wetlands Map. Accessed May 6, 2024. Available at: https://www.cityoffife.org/DocumentCenter/View/1262/Fife-Wetlands-2016-October---11-by-17-PDF?bidId=.

City of Puyallup, 2024a. "Puyallup Municipal Code." Accessed May 6, 2024. Available at: https://www.codepublishing.com/WA/Puyallup/.

City of Puyallup, 2024b. Inventory of Designated Puyallup Wetlands. City of Puyallup GIS Portal Wetland and Stream Maps. Accessed May 6, 2024. Available at: https://gis-portal-puyallup.opendata.arcgis.com/datasets/puyallup::wetlands/explore?location=47.184207%2C-122.289624%2C13.58.

Confluence Environmental Group, 2022. *Vector Development Company Freeman Road Logistics Warehouse: Third-Party Review of Critical Areas Report*. March 4, 2022.

Confluence Environmental Group, 2024a. *Vector Development Company Freeman Road Logistics Project: Third-Party Second Review of Critical Areas Report*. February 29, 2024.

Confluence Environmental Group, 2024b. *Vector Development Company Freeman Road Logistics Project: Third-Party Third Review of Critical Areas Report*. August 15, 2024.

Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe, 1979. *Classification of Wetlands and Deepwater Habitats of the United States.* FWS/OBS-79/31. U.S. Fish and Wildlife Service. December 1979.

Ecology (Washington State Department of Ecology), 1997. Washington State Wetland Identification and Delineation Manual. Publication No. 96-94. 1997.

Ecology, 2023. "WRIA 10 Puyallup-White Watershed." Water Resource Inventory Area Maps. Accessed June 6, 2023. Available at: https://ecology.wa.gov/Water-Shorelines/Water-supply/Water-availability/In-your-watershed/Puyallup-White.

Ecology and USACE (Washington State Department of Ecology; U.S. Army Corps of Engineers), 2013. *Credit Guide for Wetland Mitigation Banks*. Publication No. 12-06-014. February 2013.

Ecology, USACE, and EPA (Washington State Department of Ecology; U.S. Army Corps of Engineers; U.S. Environmental Protection Agency), 2021. *Wetland Mitigation in Washington State–Part 1: Agency Policies and Guidance*. Version 2. Washington State Department of Ecology Publication No. 21-06-003.

Environmental Laboratory, 1987. Corps of Engineers Wetland Delineation Manual. Technical Report Y-87-1. U.S. Army Waterways Experiment Station. January 1987.

FEMA (Federal Emergency Management Agency), 1999. FEMA Flood Insurance Rate Map (FIRM). Community Panel Number 53053C0329E. Accessed September 15, 2022. Available at: https://msc.fema.gov/portal.

Herrera (Herrera Environmental Consultants), 2022. Excerpts from "SR 167 Completion Project, Stage 2, Wetland and Stream Assessment Report." Prepared for WSDOT. September 12, 2022.

Hruby, T., 2014. *Washington State Wetland Rating System for Western Washington: 2014 Update*. Washington State Department of Ecology. Publication No. 14-06-029. October 2014.

Lichvar, R.W., D.L. Banks, W.N. Kirchner, and N.C. Melvin, 2016. "The National Wetland Plant List: 2016 Wetland Ratings." *Phytoneuron* 2016(30):1–17.

Mitigation Bank (Port of Tacoma Upper Clear Creek Mitigation Bank), 2020. Mitigation Banking Instrument. Prepared By: Port of Tacoma and GeoEngineers, Inc. Tacoma, Washington. February 2020.

Munsell (Munsell Color), 2000. *Munsell Soil Color Charts*. Grand Rapids, Michigan: Munsell Color.

NMFS (National Marine Fisheries Service), 2008. "Endangered Species Act Section 7 Formal Consultation and Magnuson-Stevens Fishery Conservation and Management Act Essential Fish Habitat Consultation for the On-Going National Flood Insurance Program Carried Out in the Puget Sound Area in Washington State. HUC 17110020 Puget Sound. Accessed September 28, 2023. Available at: https://www.skagitriverhistory.com/FEMA/nfip-final-bo.pdf

NMFS, 2024. "Regions – West Coast." Endangered Species Act status reviews and listing information. Accessed May 6, 2024. Available at: http://www.westcoast.fisheries.noaa.gov/protected_species/salmon_steelhead/salmon_and_steelhead.html.

NWSA (Northwest Seaport Alliance), 2019. *Marine Cargo Economic Analysis*. Prepared by Community Attributes, Inc. January, 2019.

Pierce County, 2023. "News Flash: Moody's Investors Service Upgrades Pierce County's Rating to AAA with Stable Outlook." Accessed September 11, 2023. Available at: https://www.piercecountywa.gov/CivicAlerts.aspx?AID=6084.

Pierce County, 2024. "GIS Map Applications." Pierce County PublicGIS Interactive Mapping Tool. Accessed May 6, 2024. Available at: https://www.piercecountywa.gov/2281/GIS-Map-Applications.

Port (Port of Tacoma), 2023. "2023 Environmental Action Plan." Accessed September 11, 2023. Available at: https://www.portoftacoma.com/environment.

Reed, P.B., 1988. *National List of Plants that Occur in Wetlands: National Summary*. U.S. Fish and Wildlife Service. Prepared for National Wetlands Inventory. Biological Report 88(24). September 1988.

USACE (U.S. Army Corps of Engineers), 2010. *Regional Supplement to the Corps of Engineers Wetland Delineation Manual: Western Mountains, Valleys, and Coast Region*. Version 2.0. J.S. Wakeley, R.W. Lichvar, and C.V. Noble (eds). ERDC/EL TR-10-3. Vicksburg, Mississippi: U.S. Army Engineer Research and Development Center.

USACE, 2024. Approved Jurisdictional Determination Memorandum for Record. NWS-2023-620 Vector Development Company. USACE, Seattle District, Regulatory Branch. January 5, 2024.

USDA (U.S. Department of Agriculture), 2024. "Web Soil Survey." Natural Resources Conservation Service Soil Data. Accessed May 6, 2023. Available at: https://websoilsurvey.sc.egov.usda.gov/App/HomePage.htm.

USDA and NRCS (U.S. Department of Agriculture; Natural Resources Conservation Service), 2016. *Field Indicators of Hydric Soils in the United States: A Guide for Identifying and Delineating Hydric Soils*. Version 8.1, 2017.

USFWS (U.S. Fish and Wildlife Service), 2024a. "National Wetlands Inventory – Wetlands Mapper." Accessed May 6, 2024. Available at: https://www.fws.gov/wetlands/.

USFWS, 2024b. "IPaC Information for Planning and Consultation." Endangered Species Act Status Reviews and Listing Information. Accessed May 6, 2024. Available at: https://ecos.fws.gov/ipac/.

WDFW (Washington Department of Fish and Wildlife), 2021. Fish Passage & Diversion Screening Inventory Database Report No 935282. Accessed: September 12, 2023. Available at: https://apps.wdfw.wa.gov/fishpassagephotos/Reports/935282_Report.pdf


WDFW, 2024a. "Priority Habitats and Species: Maps." Accessed May 6, 2024. Available at: http://wdfw.wa.gov/mapping/phs/.

WDFW, 2024b. "SalmonScape." WDFW Mapping System. Accessed May 6, 2024. Available at: http://apps.wdfw.wa.gov/salmonscape/.

WDNR (Washington Department of Natural Resources), 2024. Wetlands of High Conservation Value. Accessed: May 6, 2024. Available at: https://experience.arcgis.com/experience/174566100f2a47bebe56db3f0f78b5d9/.

WSDOT (Washington Department of Transportation), 2023. *SR 167 Completion Project, Stage 2: SR 167/I-5 to SR 161 – New Expressway Project, Stage 2 Mitigation Plan*. Prepared by Herrera Environmental Consultants, Inc. September 21, 2023.


Figures

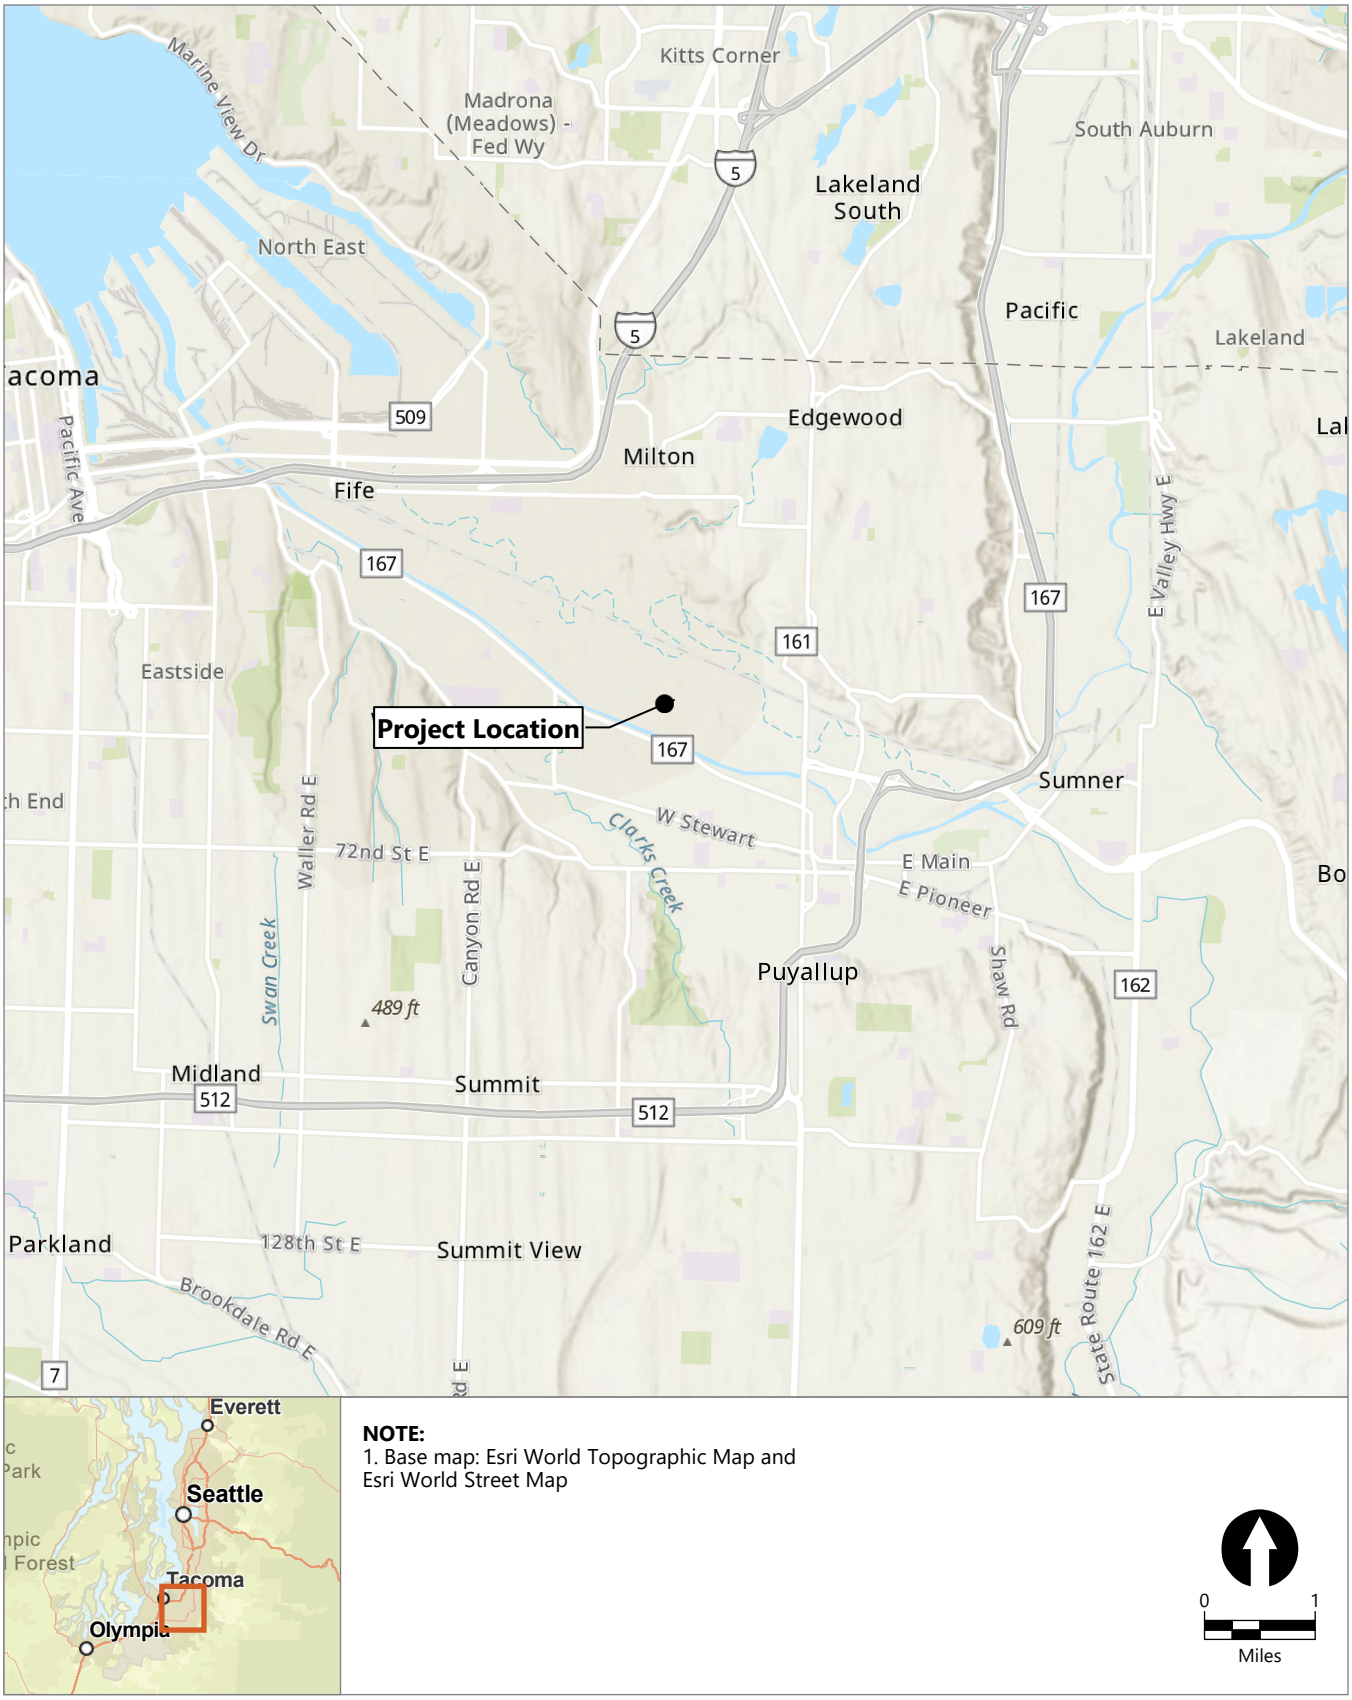

Publish Date: 2024/05/22, 2:40 PM | User: tweldyFilepath: \\GSTFile01\GIS\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 1
Vicinity Map
Critical Area Report
Freeman Road Logistics

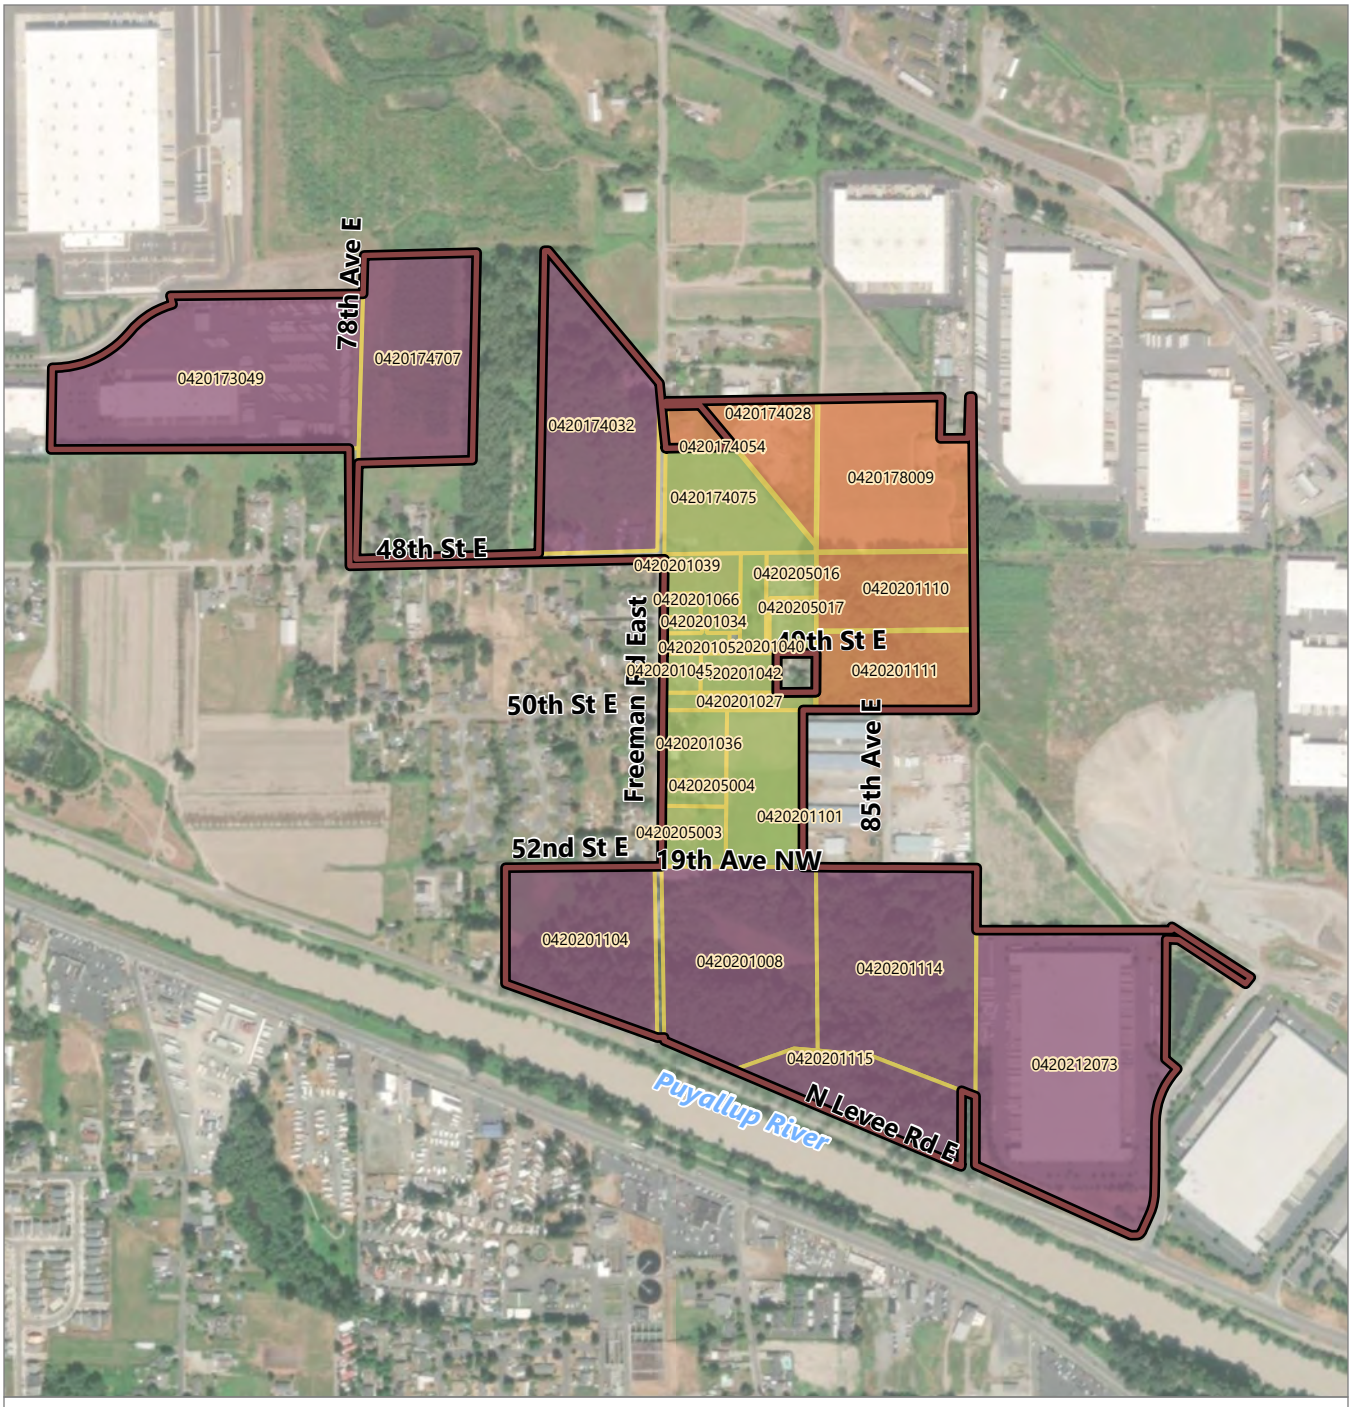

LEGEND:

- Study Area

Tax Parcel Ownership

- Main Development Area
- Other Parcels for Transportation and Utility Improvements
- WSDOT

SOURCES:
1. Aerial imagery: Esri (2022)
2. Parcel: Pierce County (2023)


NOTES:
1. USDA: United States Department of Agriculture

0 600
Feet

Publish Date: 2024/06/14, 4:40 PM | User: jquinley
Filepath: \\GSTFILE01\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 2
Study Area and Existing Conditions
Critical Area Report
Freeman Road Logistics

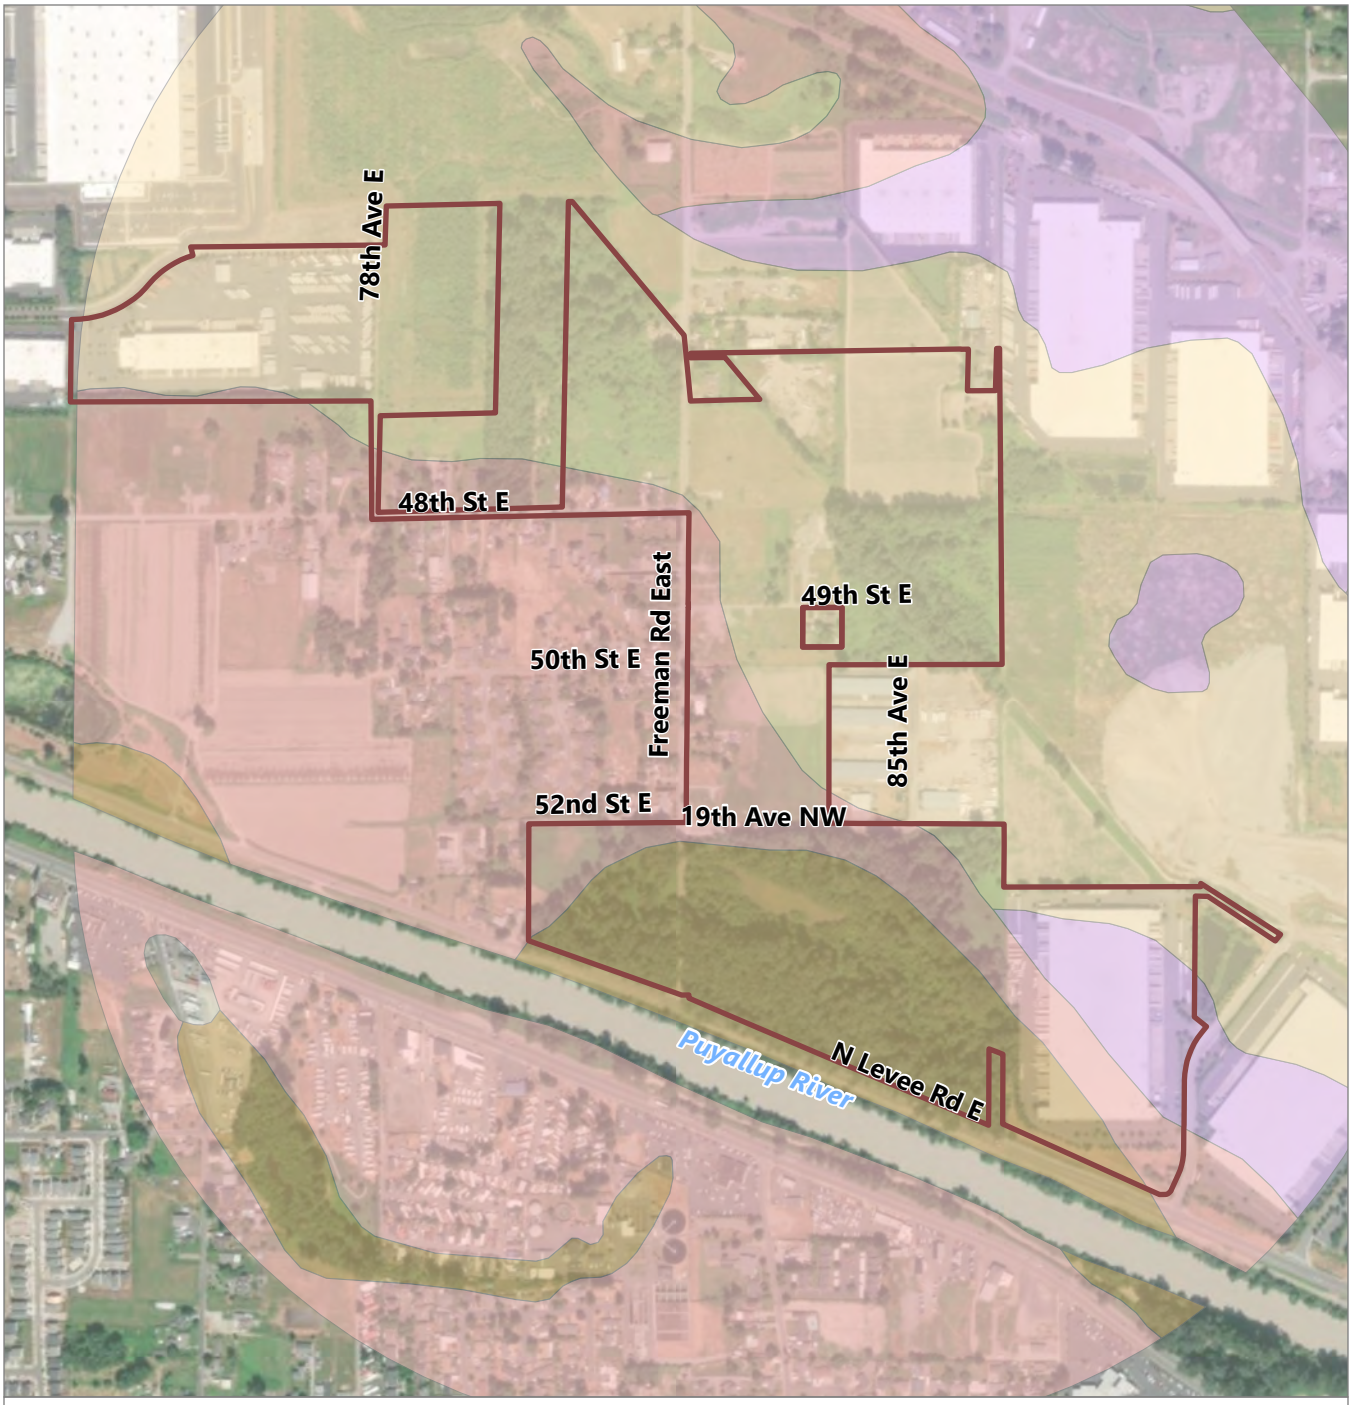

LEGEND:

- Study Area

NRCS Soils

- Briscot loam
- Pilchuck fine sand
- Puyallup fine sandy loam
- Sultan silt loam

SOURCES:
1. Soil: USDA (2023)
2. Aerial imagery: Esri (2022)


NOTES:
1. NRCS: Natural Resources Conservation Service
2. USDA: United States Department of Agriculture

0 600
Feet

Publish Date: 2024/06/14, 4:00 PM | User: jquinley
Filepath: \\GSTFILE01\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 3
NRCS Soils Map
Critical Area Report
Freeman Road Logistics

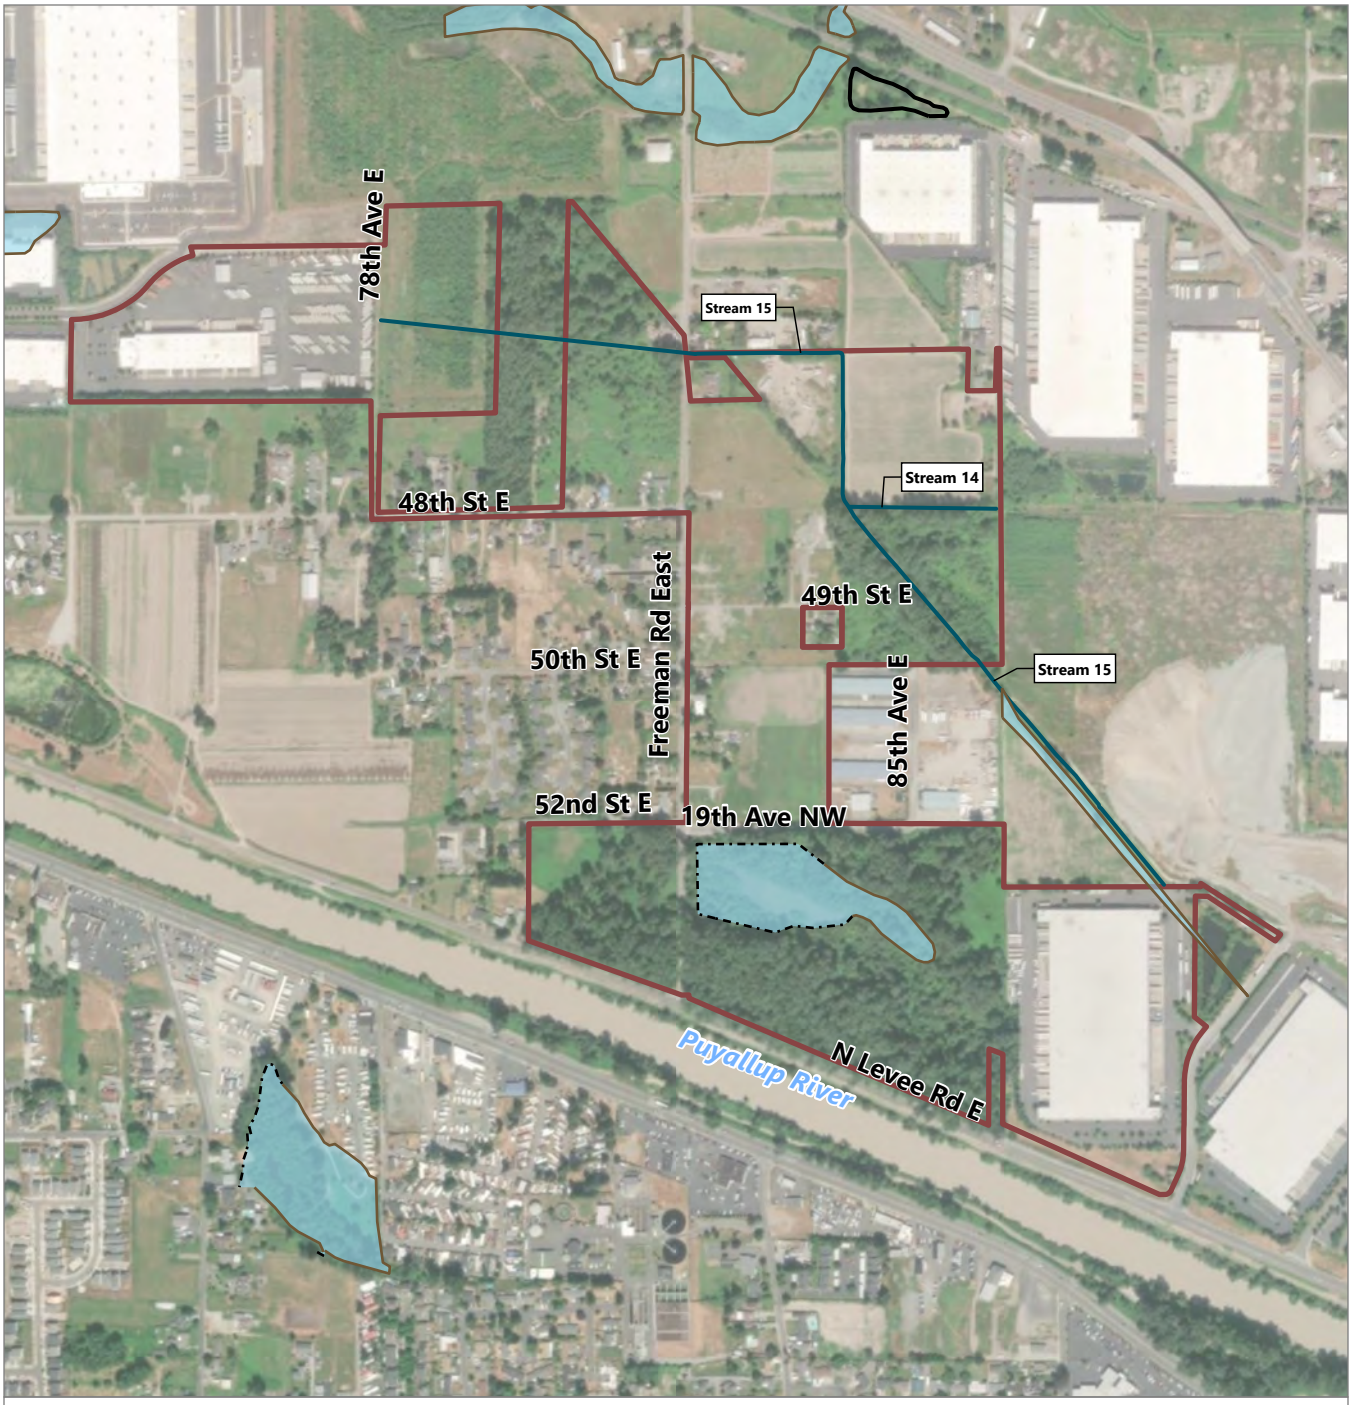

LEGEND:

- Study Area
- Stream

CWI Wetlands

- Unconfirmed
- Delineated
- Verified
- Unverified

SOURCES:
1. CWI: Pierce County (2023)
2. Stream: Pierce County (2023)
3. Aerial imagery: Esri (2022)


NOTE:
CWI: County Wetland Inventory

0 600
Feet

Publish Date: 2024/06/14, 4:00 PM | User: jquinley
Filepath: \\GSTFILE01\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 4
Pierce County Wetlands Inventory Map
Critical Area Report
Freeman Road Logistics

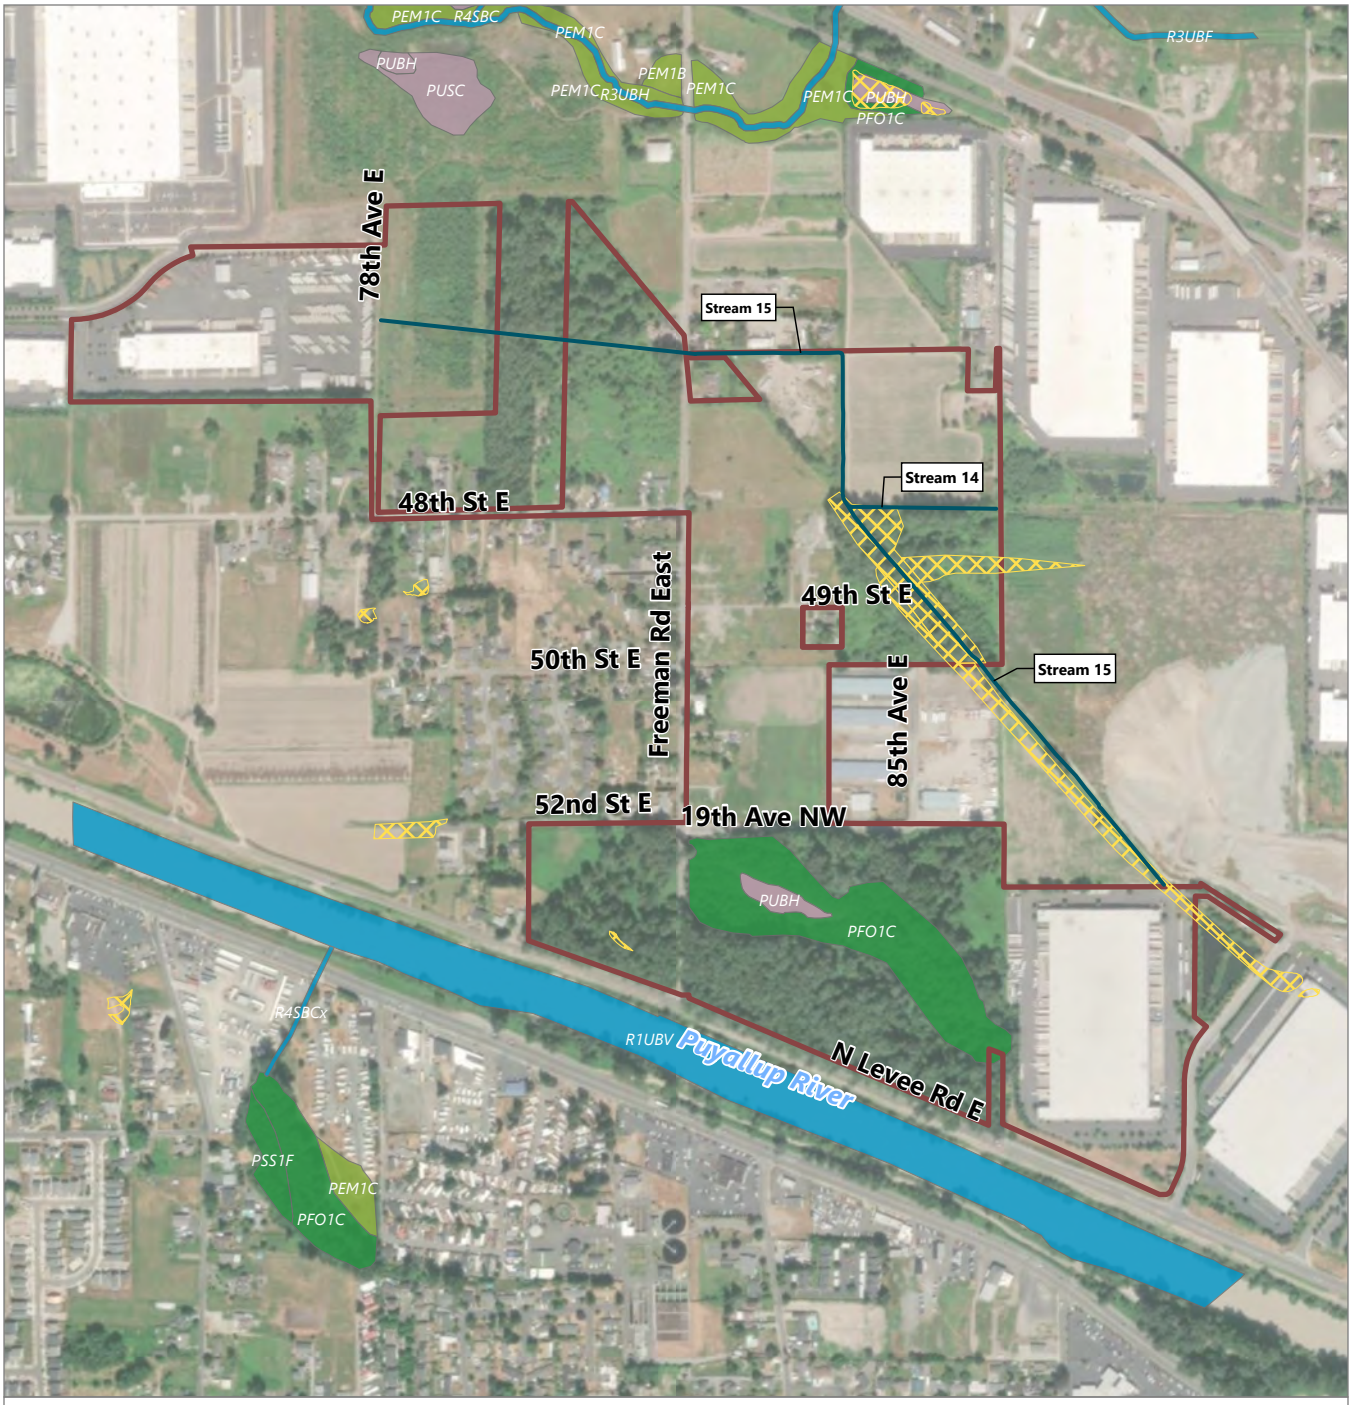

LEGEND:

- Study Area

NWI Wetlands

- Freshwater Emergent Wetland
- Freshwater Forested/Shrub Wetland
- Freshwater Pond
- Riverine
- City of Puyallup Wetland (Unverified)
- Stream

SOURCES:
1. NWI: USFWS (2023)
2. Stream: Pierce County (2023)
3. Aerial imagery: Esri (2022)


NOTES:
1. NWI: National Wetland Inventory
2. USFWS: United States Fish and Wildlife Service

0 600
Feet

Publish Date: 2024/06/14, 4:01 PM | User: jquinley
Filepath: \\GSTFILE01\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 5
USFWS National Wetlands Inventory Map
Critical Area Report
Freeman Road Logistics

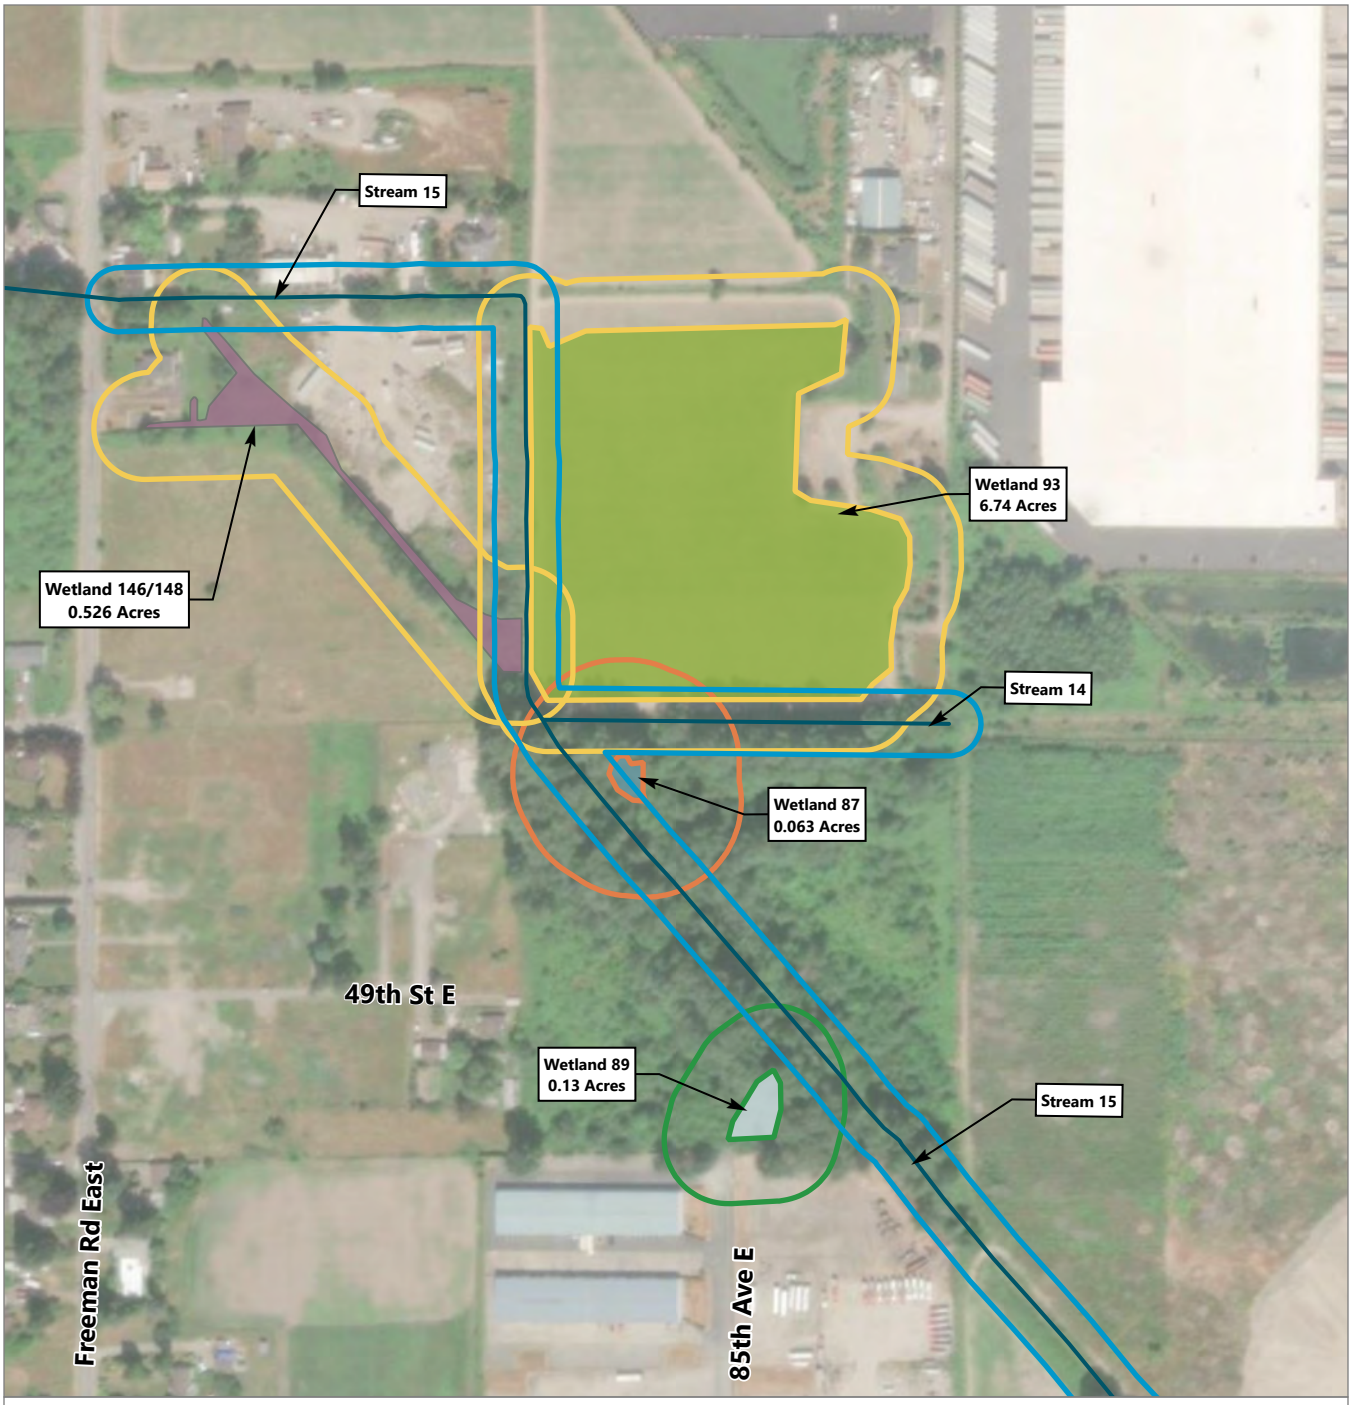

LEGEND:

- Stream
- Wetland 87, Category 3
- Wetland 89, Cateogory 2
- Wetland 93, Category 3
- Wetland 146/148, Category 3
- Category 2 - 100' Wetland Buffer
- Category 3 - 80' Wetland Buffer
- Category 3 - 150' Wetland Buffer
- Category 3 - 50' Riparian Buffer

SOURCES:
1. Stream: Pierce County (2023)
2. Parcel: Pierce County (2023)
3. Aerial imagery: Esri (2022)

NOTE:
USDA: U.S. Department of Agriculture


0 300
Feet

Publish Date: 2024/05/23, 1:13 PM | User: tweldy
Filepath: \\GSTFile01\GIS\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 6
Off-Site WSDOT Parcels Critical Areas and Buffers

Critical Area Report
Freeman Road Logistics

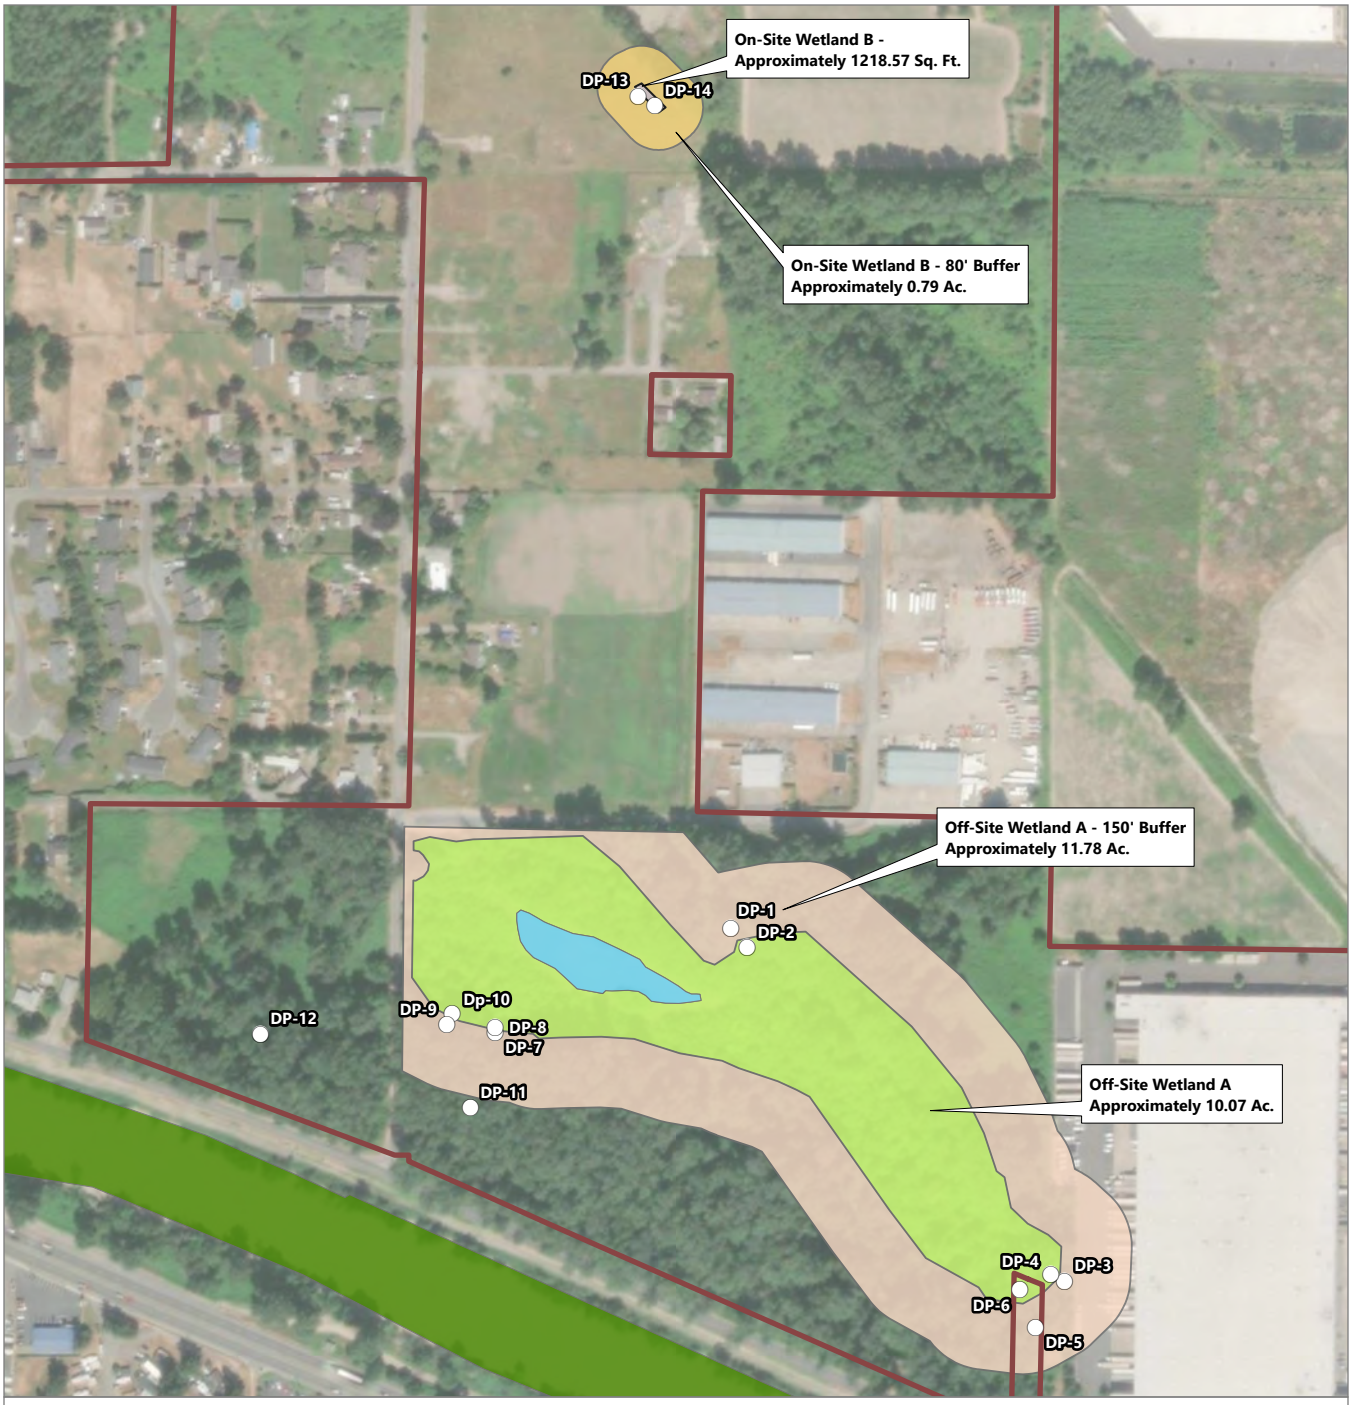

LEGEND:

- Study Area

NWI Wetlands

- Freshwater Forested/Shrub Wetland
- Freshwater Pond
- Riverine
- Wetland A - 150' Buffer
- Wetland B - 80' Buffer
- On-Site Wetland B

SOURCES:
1. Aerial imagery: Esri (2022)
2. NWI: USFWS (2023)


NOTES:
1. NWI: National Wetland Inventory
2. USFWS: United States Fish and Wildlife Service

0 500
Feet

Publish Date: 2024/06/14, 4:01 PM | User: jquinley
Filepath: \\GSTFILE01\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 7
Wetland Delineation Results
Critical Area Report
Freeman Road Logistics

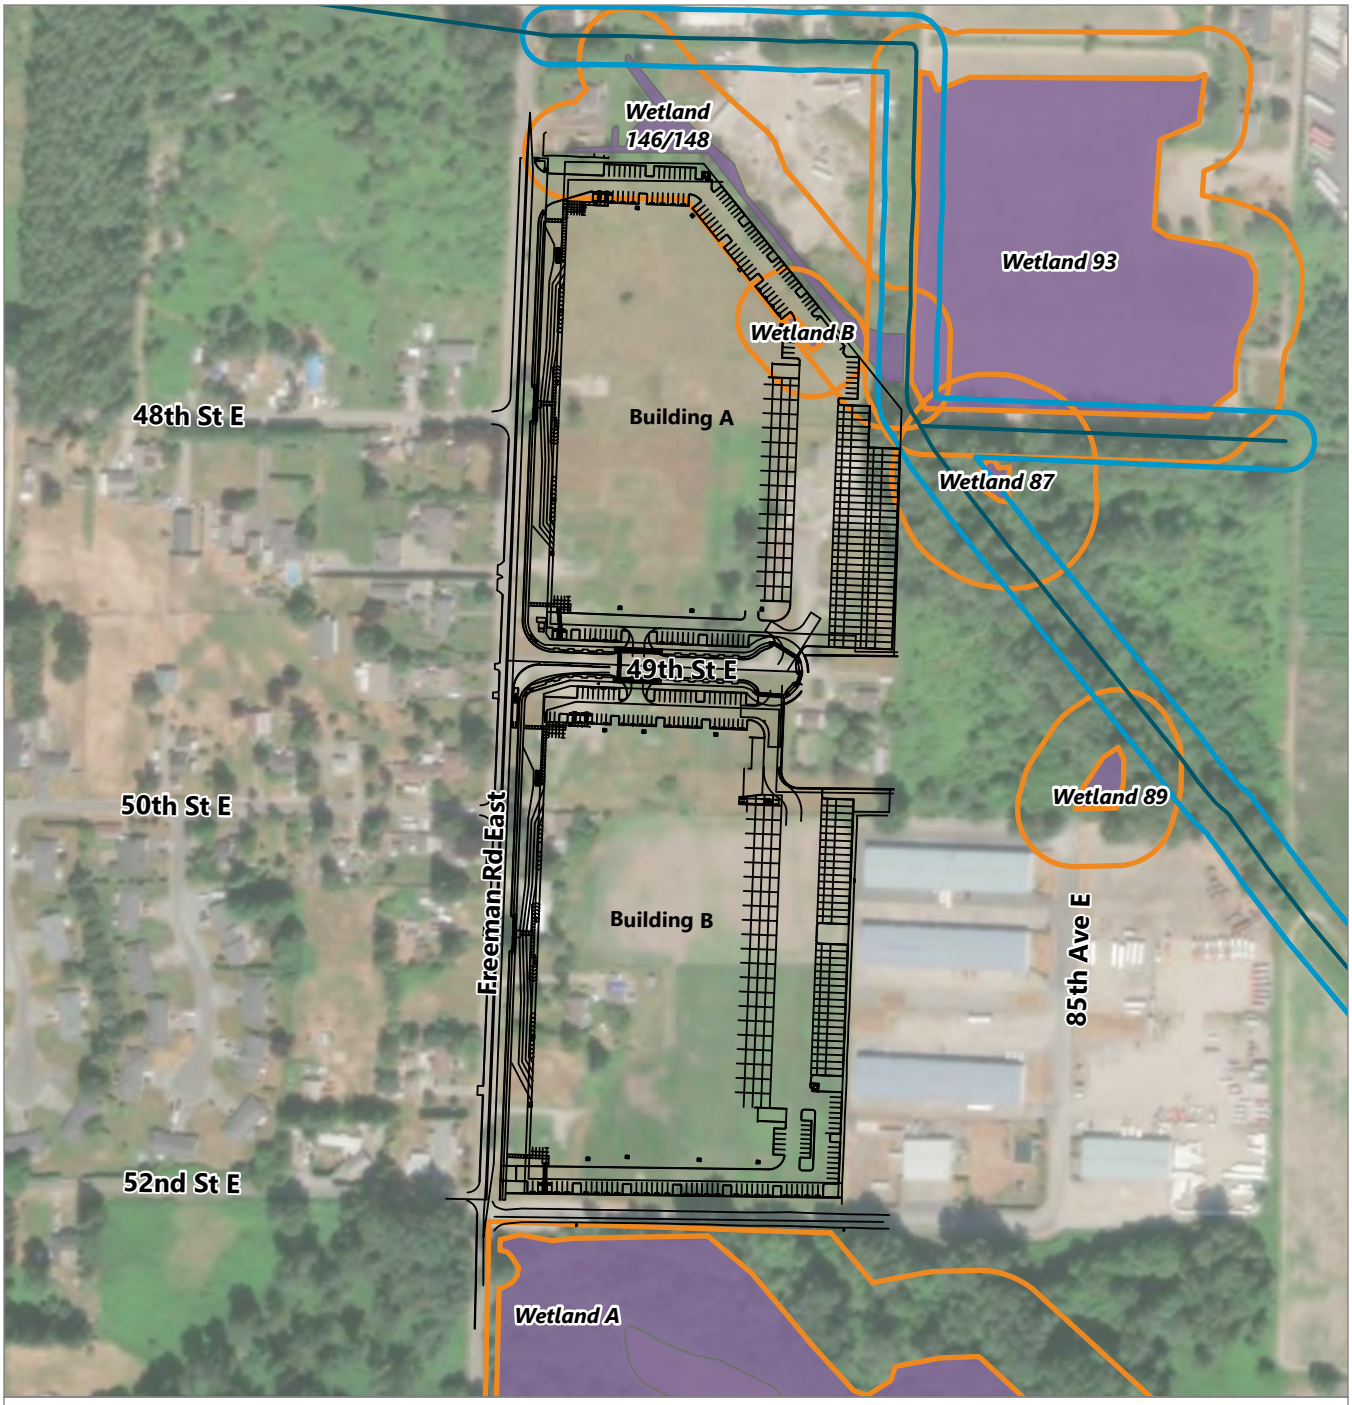

LEGEND:

- Proposed Development
- Stream
- Stream Buffer
- Wetland
- Wetland Buffer


SOURCES:
1. Stream: Pierce County (2023)
2. Aerial imagery: Esri (2022)

0 400
Feet

Publish Date: 2024/12/04, 10:31 AM | User: tweldy
Filepath: \\GSTFile01\GIS\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 8
Proposed Freeman Road Development and Critical Areas
Critical Area Report
Freeman Road Logistics

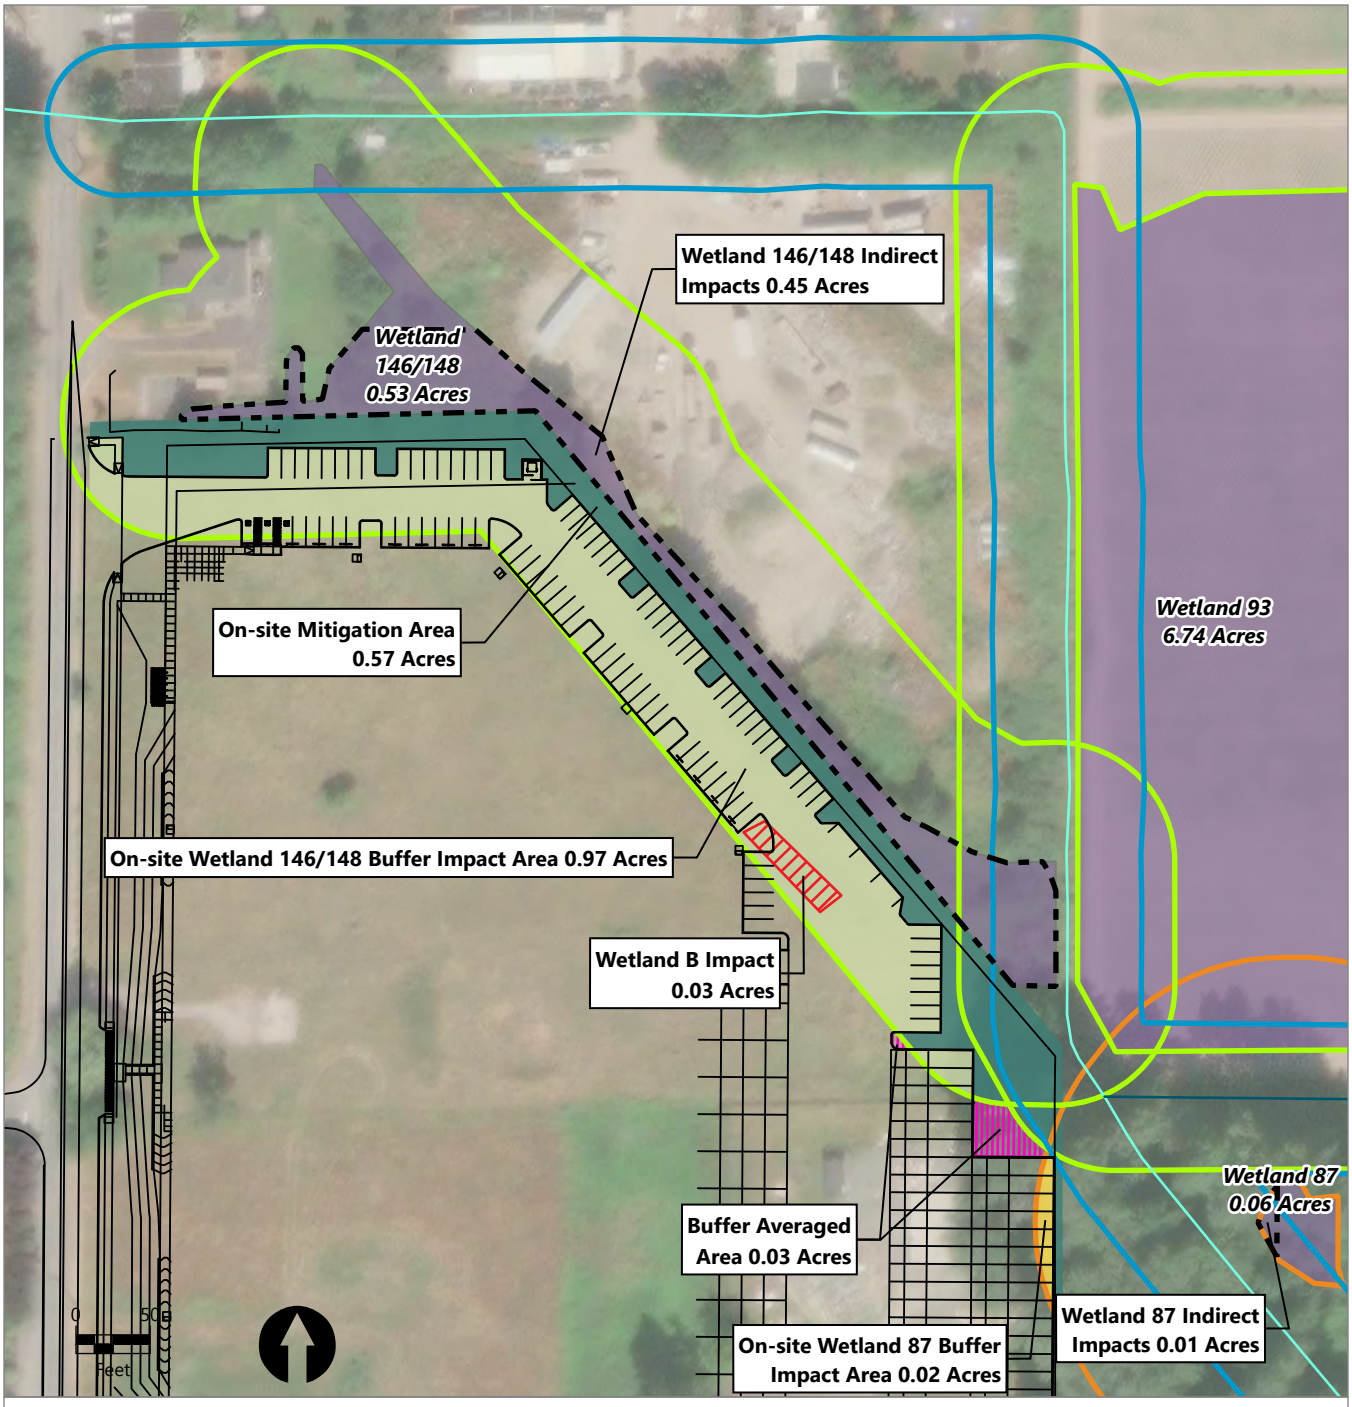

Publish Date: 2024/12/12, 12:50 PM | User: tweldy
Filepath: \\GSTFile01\GIS\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 9
Conceptual Mitigation Plan
Critical Area Report
Freeman Road Logistics


Appendix A
Site Plan and Construction Details

PROJECT DATA

SITE AREA	978,982	SF
BUILDING AREA	503,969	SF
COVERAGE	51.5%	
NORTH BUILDING PARKING REQUIRED	127.6	
12,800 SF OFFICE @ 1:300	42.7	
3,000 SF FUT OFFICE MEZZANINE @ 1:300	10.0	
224,787 SF WHSE @ 1:3000	74.9	
PARKING PROVIDED	128	
SOUTH BUILDING PARKING REQUIRED	135.7	
12,300 SF OFFICE @ 1:300	41.0	
3,000 SF FUT OFFICE MEZZANINE @ 1:300	10.0	
254,082 SF WHSE @ 1:3000	84.7	
PARKING PROVIDED	136	
▲ 9'x10' DOCK DOOR	66	
● GRADE ACCESS DOORS (SIZE VARIES)	7	

VICINITY MAP

PUYALLUP, WASHINGTON

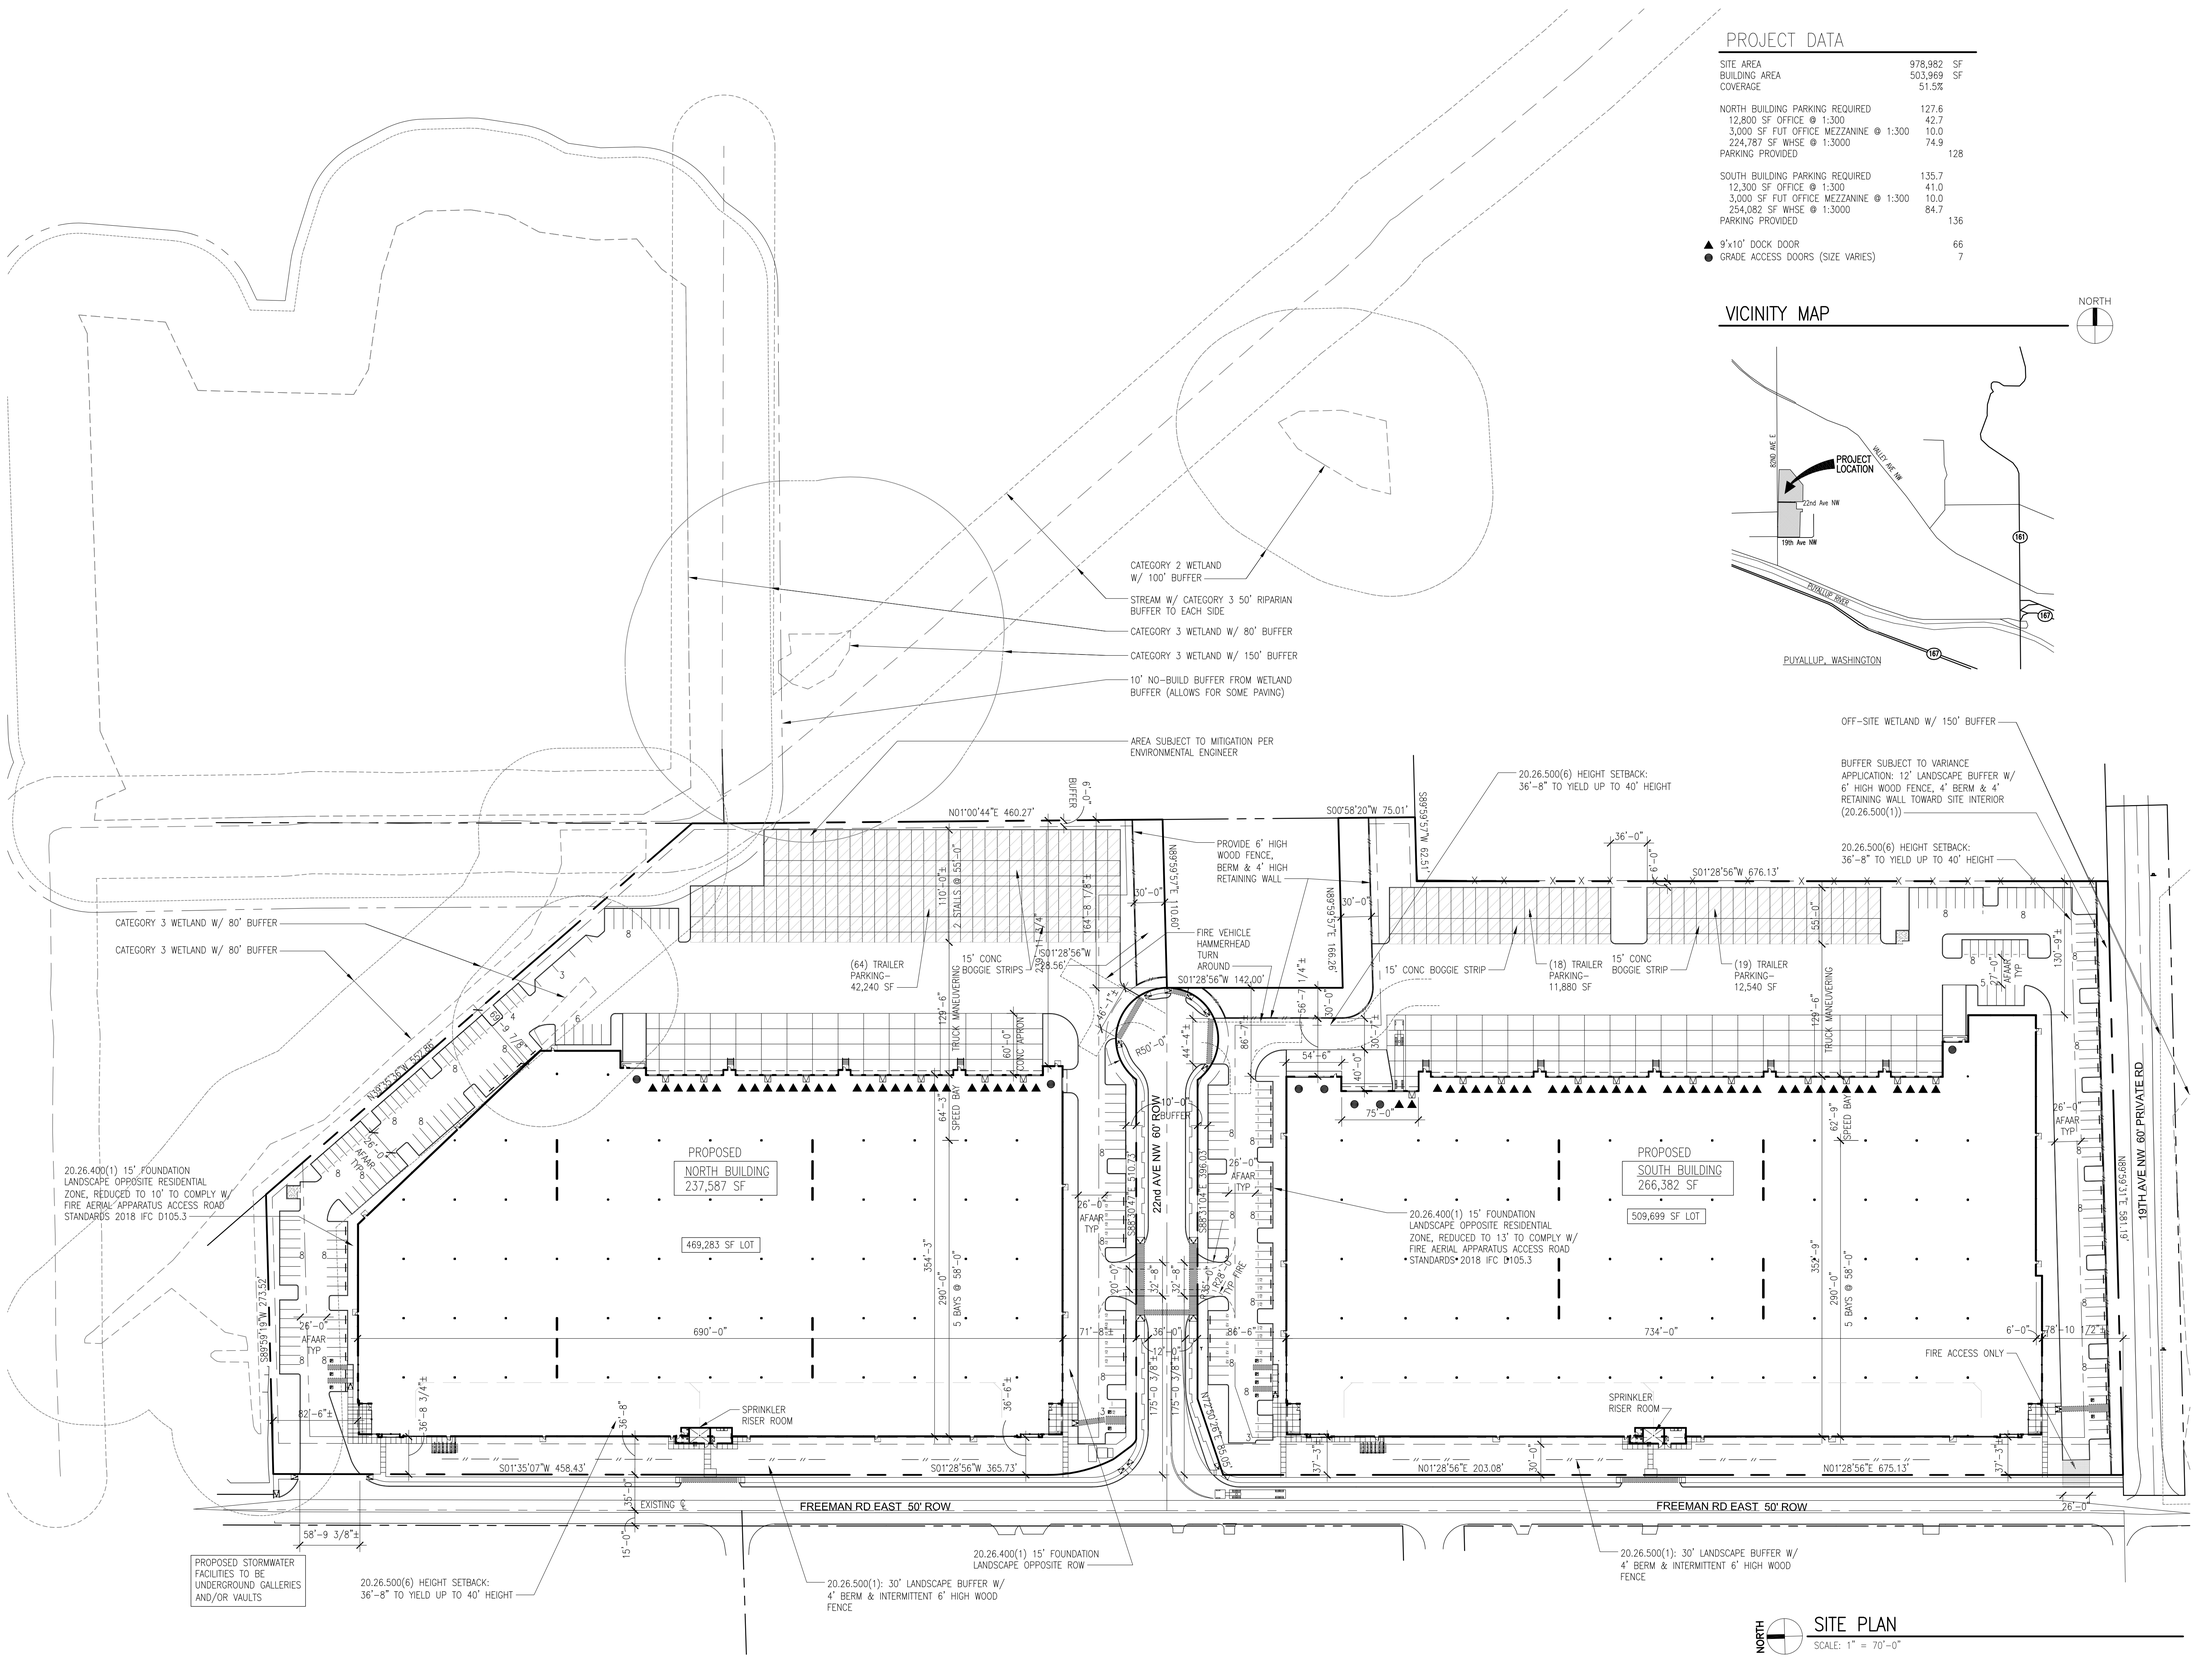

NORTH

SITE PLAN

SCALE: 1" = 70'-0"

SYNTHESIS PLLC
THE FUSION OF ARCHITECTURE, DESIGN TECHNOLOGY & PEOPLE

12503 Bel-Red Road, Suite 100
Bellevue, WA 98005
p 425 646 1818 f 425 646 4141

VECTOR
Development Company
11411 NE 124th Street
Suite 190
Kirkland, WA 98034

IMPORTANT:

Please read this agreement before accepting this drawing/computer media.

Use of this drawing/computer media's content indicates your acceptance of the following disclaimer:

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by SynThesis PLLC as instruments of service shall remain the property of SynThesis PLLC. SynThesis PLLC shall retain all common law, statutory and other reserved rights, including the copyright thereto.

If authorized by SynThesis PLLC, the recipient will provide additional copies of this disclaimer and include it with any information duplicated from the drawings/computer media's contents when distributed to others.

The information will be used at the recipients own risk. SynThesis PLLC does not warrant the information in any way and understands that the contents will be used by the recipient for informational purposes only.

The enclosed drawings/computer media represent as-designed conditions only. Field verify all critical dimensions. Actual as-built conditions may vary.

The recipient agrees to the fullest extent permitted by law to indemnify, defend, and hold harmless SynThesis PLLC from and against all claims, liabilities, losses, damages and costs, including, but not limited to, attorneys' fees arising out of, or in any way connected with, the modification, misinterpretation, misuse, or reuse by others of the drawings/computer media and data provided by SynThesis PLLC under this agreement. This indemnification applies without limitation to any use of the project documentation on other projects, for addition to this project, or for completion of this project by others, excepting only such use as may be authorized in writing by SynThesis PLLC.

If this disclaimer is unacceptable by the recipient, please advise SynThesis PLLC before proceeding with the use of the drawings/computer media's contents.

REVISIONS

ISSUE NO.	DATE	ITEM
3	06 14 24	SEPA RESUBMITTAL
2	11 27 23	SEPA RESUBMITTAL
1	10 14 22	SEPA RESUBMITTAL
D	11 01 21	DESIGN REVIEW APPLICATION
C	09 15 21	PRELIMINARY BID
B	03 19 21	SEPA APPLICATION
A	01 05 21	PRE-APPLICATION

PROFESSIONAL STAMP

PROGRESS PRINTING
November 12, 2024

NOT FOR CONSTRUCTION

PROJECT INFORMATION

NORTH & SOUTH BUILDINGS
Freeman Road Logistics
Puyallup, WA

SHEET INFORMATION

RELEASE FOR: PERMIT SUBMITTAL
TITLE: SITE PLAN

DESIGNED BY:
DRAWN BY:
REVIEWED BY:
APPROVED BY:
DATE: 01 05 21
SHEET NO: A1.1
PROJECT NO: 201401.13.031


www.synthesispllc.com


© 2024 SYNTHESISPLLC


P:\201401 - KEITH RDA ESTATE\13 - Puyallup\201 - Freeman Road Logistics North\CAD\2024-11-15\201401 - Standard(2024).dwg, 11/15/2024 3:45 PM


PRELIMINARY WATER AND SEWER PLAN
OF
FREEMAN LOGISTICS
PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON




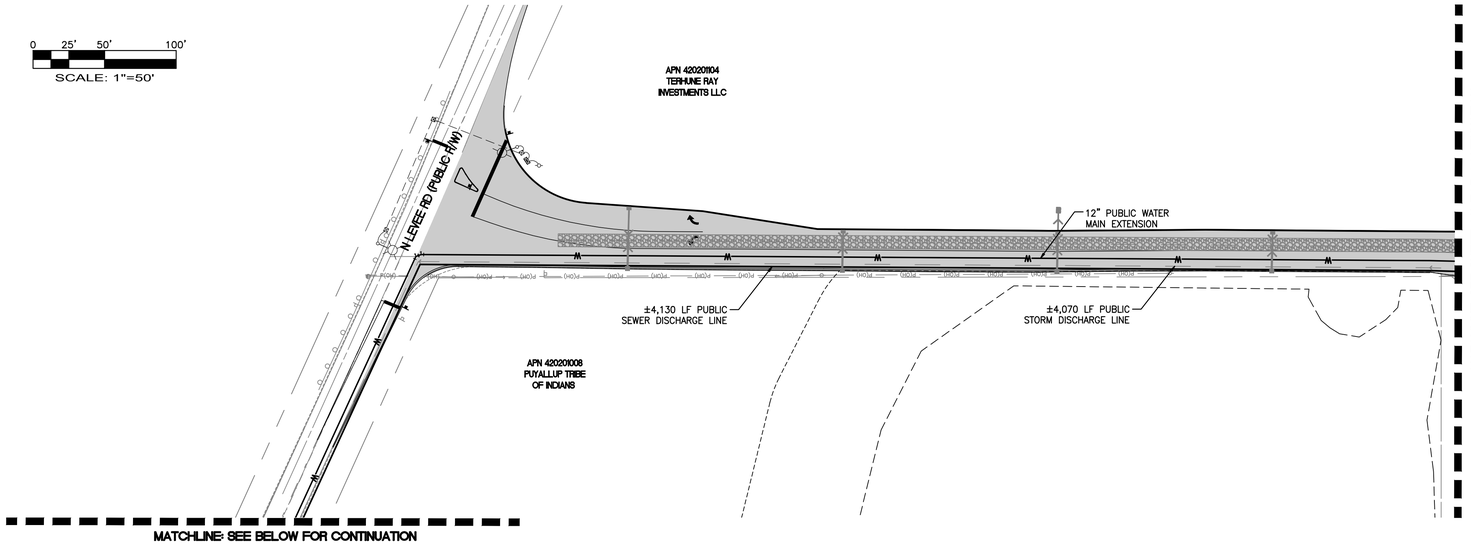



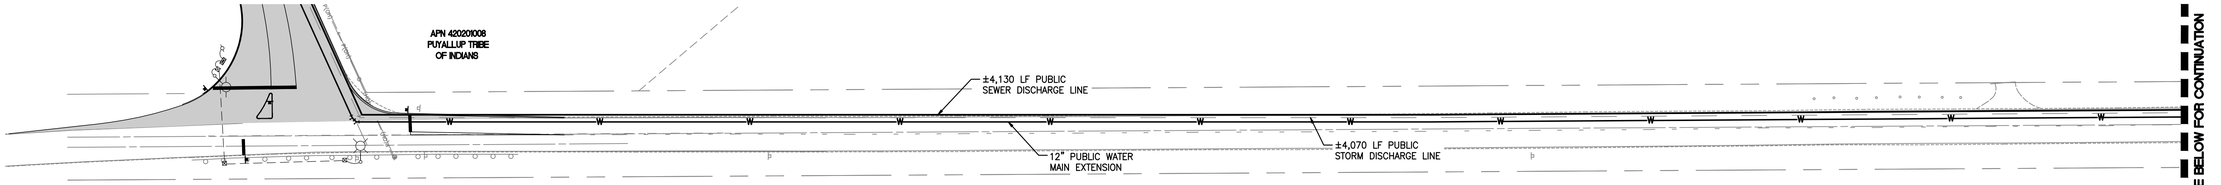



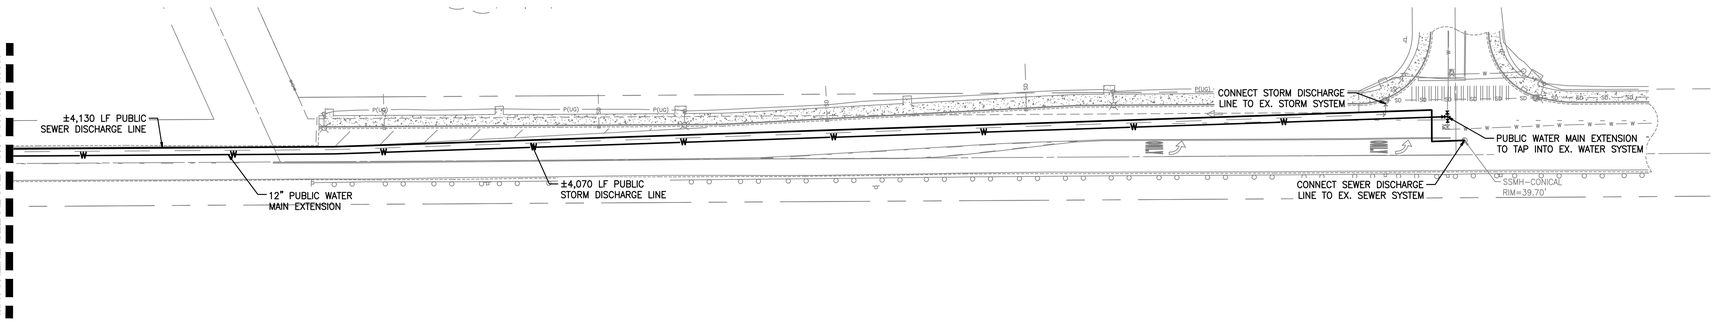

ENGINEER'S REVIEW
- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE.
THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND OR OMISSIONS ON THESE PLANS.
FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
5	12/13/24	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: **PRELIMINARY WATER AND SEWER PLAN**

FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCCASEY
STATE OF WASHINGTON
24927
REGISTERED
PROFESSIONAL ENGINEER
PRELIMINARY
12/13/24

Scale: Horizontal 1"=50' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 12/13/24

Barghausen
Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

Job Number 21585

Sheet C19 of 44

P:\21000s\21585\engineering\SEPA SET\21585-WS.dwg 12/12/2024 1:57 PM DCASEY

PRELIMINARY ROAD IMPROVEMENT FREEMAN AND LEVEE INTERSECTION

OF


FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

N

0 15' 30' 60'


SCALE: 1"=30'

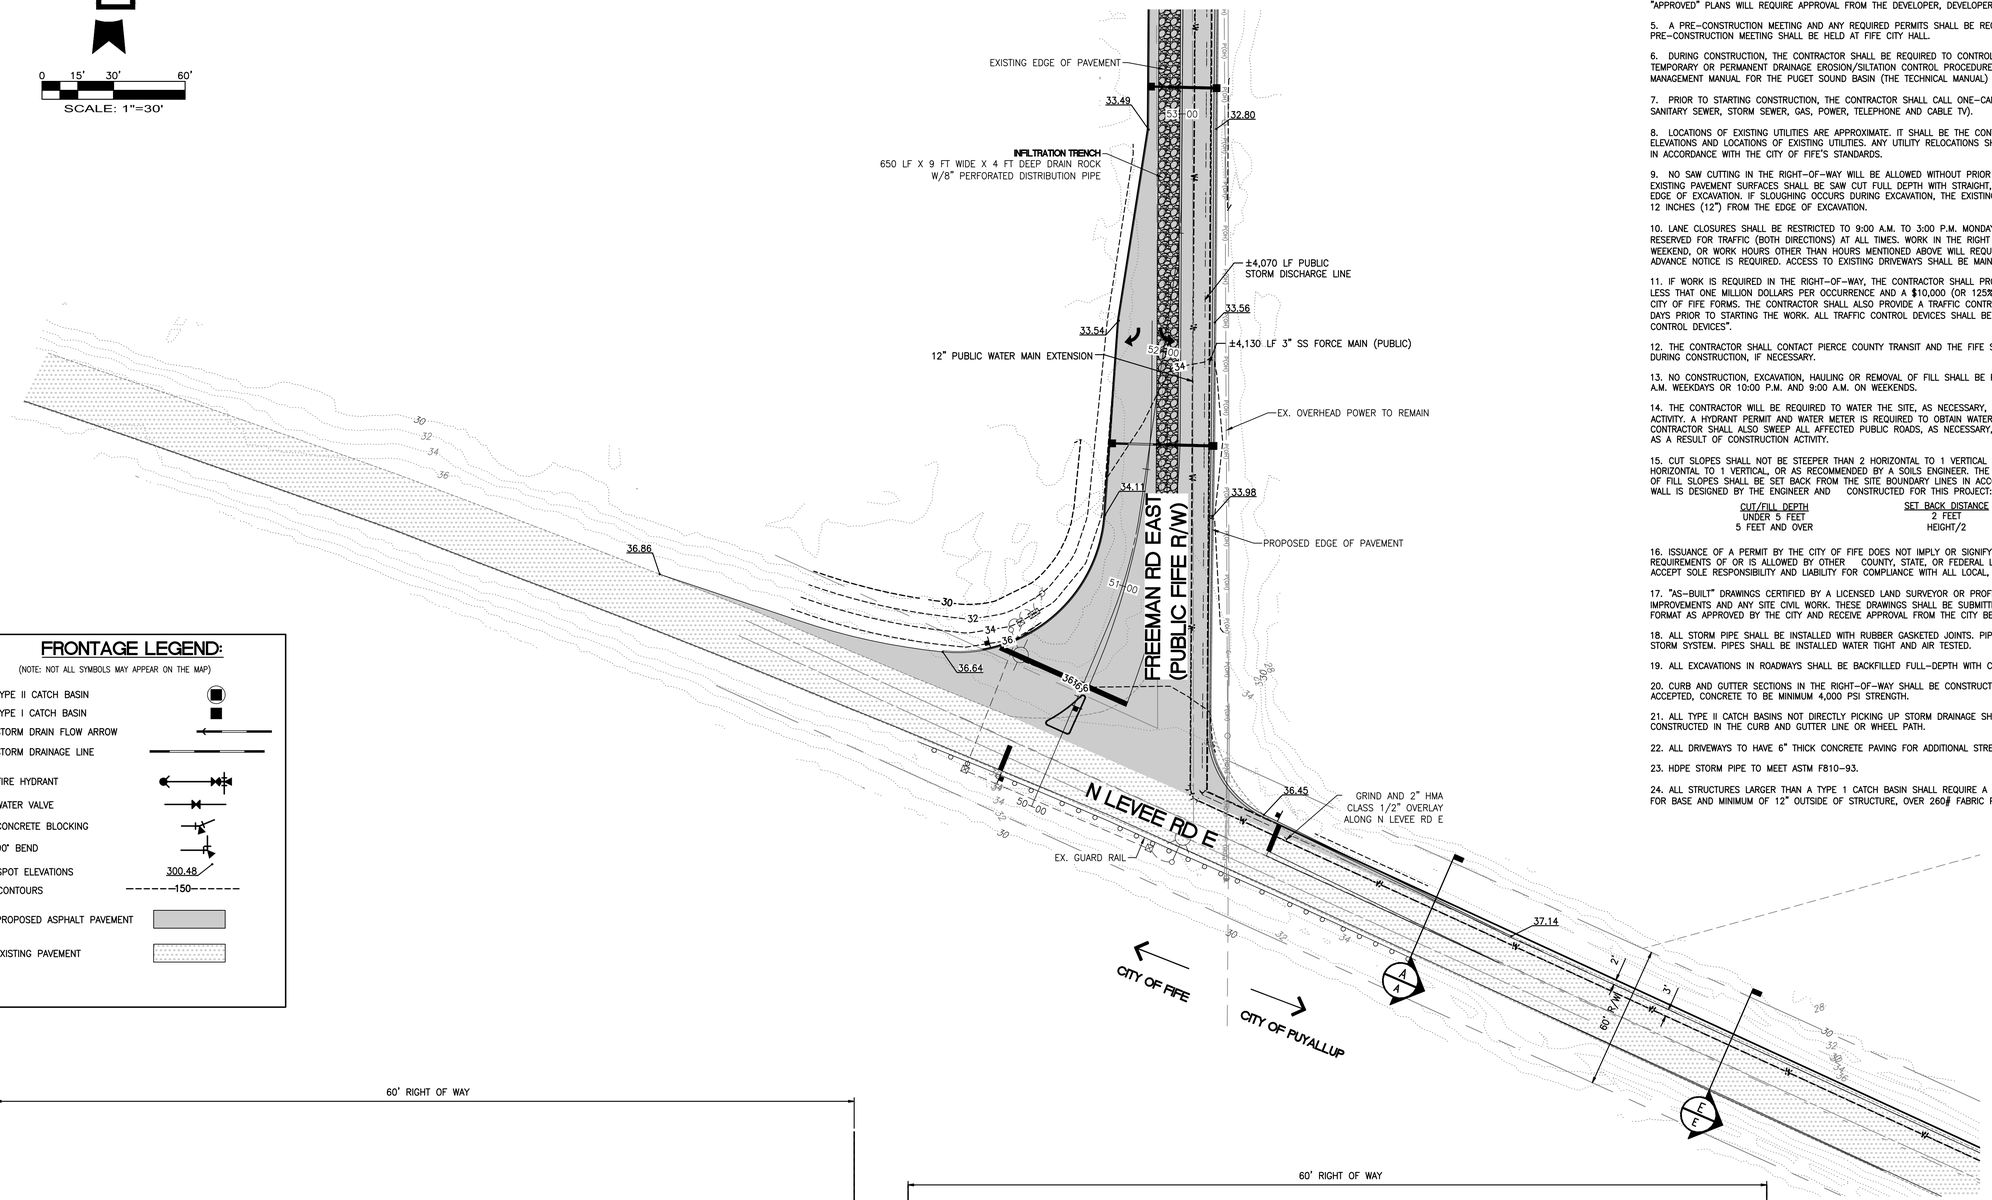

FRONTAGE LEGEND:


(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS 150
- PROPOSED ASPHALT PAVEMENT
- EXISTING PAVEMENT

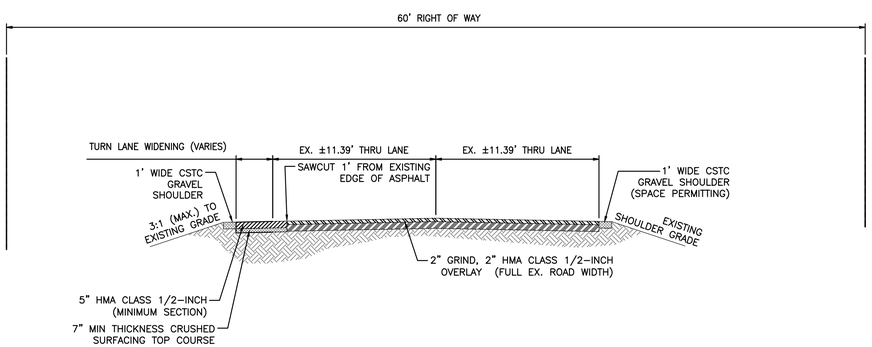

NORTH LEVEE ROAD EAST SECTION A

NOT TO SCALE

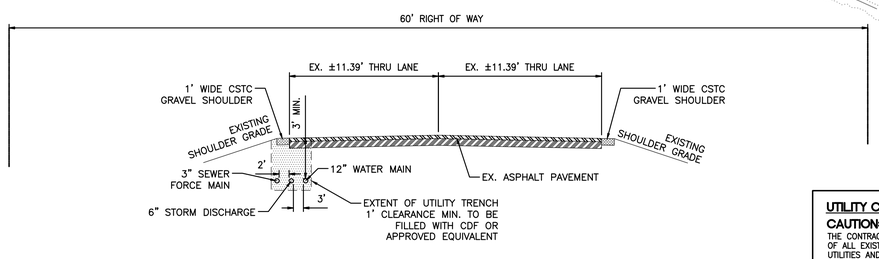

NORTH LEVEE ROAD EAST SECTION E

NOT TO SCALE

CITY OF FIFE GENERAL NOTES

1. ALL SPECIFICATIONS, MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE CITY OF FIFE MUNICIPAL CODE, THE LATEST EDITION OF THE WSDOT/APWA STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION, AND THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES.

2. PLANS AND DETAILS SHALL BE IN ACCORDANCE WITH THE CITY OF FIFE MUNICIPAL CODE AND THE LATEST EDITION OF THE WSDOT/APWA STANDARD PLANS.

3. A COPY OF THE APPROVED PLANS SHALL BE ON SITE DURING CONSTRUCTION.

4. CONSTRUCTION OF PROPOSED IMPROVEMENTS SHALL BE IN ACCORDANCE WITH THE APPROVED PLANS. ANY CHANGES FROM THE "APPROVED" PLANS WILL REQUIRE APPROVAL FROM THE DEVELOPER, DEVELOPERS ENGINEER AND THE CITY OF FIFE.

5. A PRE-CONSTRUCTION MEETING AND ANY REQUIRED PERMITS SHALL BE REQUIRED PRIOR TO ANY WORK ACTIVITY. THE PRE-CONSTRUCTION MEETING SHALL BE HELD AT FIFE CITY HALL.

6. DURING CONSTRUCTION, THE CONTRACTOR SHALL BE REQUIRED TO CONTROL ON SITE STORM WATER RUNOFF BY USING APPROVED TEMPORARY OR PERMANENT DRAINAGE EROSION/SILTATION CONTROL PROCEDURES. THE CITY OF FIFE HAS ADOPTED THE STORMWATER MANAGEMENT MANUAL FOR THE PUGET SOUND BASIN (THE TECHNICAL MANUAL) DEVELOPED BY THE DEPARTMENT OF ECOLOGY.

7. PRIOR TO STARTING CONSTRUCTION, THE CONTRACTOR SHALL CALL ONE-CALL (1-800-425-5555) FOR UTILITY LOCATIONS (WATER, SANITARY SEWER, STORM SEWER, GAS, POWER, TELEPHONE AND CABLE TV).

8. LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE TRUE ELEVATIONS AND LOCATIONS OF EXISTING UTILITIES. ANY UTILITY RELOCATIONS SHALL BE AT THE EXPENSE OF THE APPLICANT AND MUST BE IN ACCORDANCE WITH THE CITY OF FIFE'S STANDARDS.

9. NO SAW CUTTING IN THE RIGHT-OF-WAY WILL BE ALLOWED WITHOUT PRIOR APPROVAL FROM THE CITY OF FIFE. ONCE APPROVED, EXISTING PAVEMENT SURFACES SHALL BE SAW CUT FULL DEPTH WITH STRAIGHT, UNIFORM EDGES TWELVE INCHES (12") OUT FROM THE EDGE OF EXCAVATION. IF SLOUGHING OCCURS DURING EXCAVATION, THE EXISTING PAVEMENT SHALL BE SAW CUT TO ACHIEVE THE REQUIRED 12 INCHES (12") FROM THE EDGE OF EXCAVATION.

10. LANE CLOSURES SHALL BE RESTRICTED TO 9:00 A.M. TO 3:00 P.M. MONDAY THROUGH FRIDAY. ONE LANE (MINIMUM) SHALL BE RESERVED FOR TRAFFIC (BOTH DIRECTIONS) AT ALL TIMES. WORK IN THE RIGHT OF WAY REQUIRES A RIGHT-OF-WAY PERMIT. NIGHT, WEEKEND, OR WORK HOURS OTHER THAN HOURS MENTIONED ABOVE WILL REQUIRE THE CITY OF FIFE ENGINEER'S APPROVAL. A THREE DAY ADVANCE NOTICE IS REQUIRED. ACCESS TO EXISTING DRIVEWAYS SHALL BE MAINTAINED AT ALL TIMES.

11. IF WORK IS REQUIRED IN THE RIGHT-OF-WAY, THE CONTRACTOR SHALL PROVIDE PROOF OF LIABILITY INSURANCE IN AN AMOUNT NO LESS THAT ONE MILLION DOLLARS PER OCCURRENCE AND A $10,000 (OR 125% OF CONSTRUCTION COSTS) RESTORATION/DEFECT BOND ON CITY OF FIFE FORMS. THE CONTRACTOR SHALL ALSO PROVIDE A TRAFFIC CONTROL PLAN FOR REVIEW AND APPROVAL A MINIMUM OF FIVE(5) DAYS PRIOR TO STARTING THE WORK. ALL TRAFFIC CONTROL DEVICES SHALL BE IN ACCORDANCE WITH THE "MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES".

12. THE CONTRACTOR SHALL CONTACT PIERCE COUNTY TRANSIT AND THE FIFE SCHOOL DISTRICT FOR COORDINATING BUS STOP OPERATIONS DURING CONSTRUCTION, IF NECESSARY.

13. NO CONSTRUCTION, EXCAVATION, HAULING OR REMOVAL OF FILL SHALL BE PERMITTED BETWEEN THE HOURS OF 10:00 P.M. AND 7:00 A.M. WEEKDAYS OR 10:00 P.M. AND 9:00 A.M. ON WEEKENDS.

14. THE CONTRACTOR WILL BE REQUIRED TO WATER THE SITE, AS NECESSARY, TO REDUCE EMISSIONS AS A RESULT OF CONSTRUCTION ACTIVITY. A HYDRANT PERMIT AND WATER METER IS REQUIRED TO OBTAIN WATER FROM THE CITY OF FIFE'S WATER SYSTEM. THE CONTRACTOR SHALL ALSO SWEEP ALL AFFECTED PUBLIC ROADS, AS NECESSARY, OR AS DIRECTED BY THE CITY, TO REMOVE MUD DEPOSITS AS A RESULT OF CONSTRUCTION ACTIVITY.

15. CUT SLOPES SHALL NOT BE STEEPER THAN 2 HORIZONTAL TO 1 VERTICAL AND FILL SLOPES SHALL NOT BE STEEPER THAN 1-1/2 HORIZONTAL TO 1 VERTICAL, OR AS RECOMMENDED BY A SOILS ENGINEER. THE CATCH POINTS OF THE TOP OF CUT SLOPES AND BOTTOM OF FILL SLOPES SHALL BE SET BACK FROM THE SITE BOUNDARY LINES IN ACCORDANCE WITH THE FOLLOWING TABLE, UNLESS A RETAINING WALL IS DESIGNED BY THE ENGINEER AND CONSTRUCTED FOR THIS PROJECT:

CUT/FILL DEPTH	SET BACK DISTANCE
UNDER 5 FEET	2 FEET
5 FEET AND OVER	HEIGHT/2

16. ISSUANCE OF A PERMIT BY THE CITY OF FIFE DOES NOT IMPLY OR SIGNIFY THAT THE PROPOSED WORK COMPLIES WITH THE REQUIREMENTS OF OR IS ALLOWED BY OTHER COUNTY, STATE, OR FEDERAL LAWS, ORDINANCES, OR REGULATIONS. APPLICANT WILL ACCEPT SOLE RESPONSIBILITY AND LIABILITY FOR COMPLIANCE WITH ALL LOCAL, STATE, AND FEDERAL REQUIREMENTS.

17. "AS-BUILT" DRAWINGS CERTIFIED BY A LICENSED LAND SURVEYOR OR PROFESSIONAL ENGINEER ARE REQUIRED FOR RIGHT-OF-WAY IMPROVEMENTS AND ANY SITE CIVIL WORK. THESE DRAWINGS SHALL BE SUBMITTED ON 24" X 36" MYLAR, ON CD IN ELECTRONIC PDF FORMAT AS APPROVED BY THE CITY AND RECEIVE APPROVAL FROM THE CITY BEFORE A CERTIFICATE OF OCCUPANCY IS ISSUED.

18. ALL STORM PIPE SHALL BE INSTALLED WITH RUBBER GASKETED JOINTS. PIPES SHALL NOT ALLOW INTRUSION OF GROUNDWATER INTO STORM SYSTEM. PIPES SHALL BE INSTALLED WATER TIGHT AND AIR TESTED.

19. ALL EXCAVATIONS IN ROADWAYS SHALL BE BACKFILLED FULL-DEPTH WITH CRUSHED ROCK BASE COURSE COMPACTED TO 95% MDD.

20. CURB AND GUTTER SECTIONS IN THE RIGHT-OF-WAY SHALL BE CONSTRUCTED USING FORMS. EXTRUDED APPLICATIONS SHALL NOT BE ACCEPTED, CONCRETE TO BE MINIMUM 4,000 PSI STRENGTH.

21. ALL TYPE II CATCH BASINS NOT DIRECTLY PICKING UP STORM DRAINAGE SHALL HAVE ROUND SOLID LOCKING LIDS. LIDS WILL NOT BE CONSTRUCTED IN THE CURB AND GUTTER LINE OR WHEEL PATH.

22. ALL DRIVEWAYS TO HAVE 6" THICK CONCRETE PAVING FOR ADDITIONAL STRENGTH. MIN. 4,000 PSI STRENGTH.

23. HDPE STORM PIPE TO MEET ASTM F810-93.

24. ALL STRUCTURES LARGER THAN A TYPE 1 CATCH BASIN SHALL REQUIRE A MINIMUM OF 12" THICKNESS OF 4" - 8" QUARRY SPALLS FOR BASE AND MINIMUM OF 12" OUTSIDE OF STRUCTURE, OVER 260# FABRIC PER ASTM D-4632

ENGINEER'S REVIEW

FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

CALL BEFORE YOU DIG: 1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:

THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
5	12/13/24	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY ROAD IMPROVEMENT FREEMAN AND LEVEE INTERSECTION FOR FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCARTOR — STATE OF WASHINGTON — 24927 — REGISTERED PROFESSIONAL ENGINEER

PRELIMINARY

12/13/24

Scale: Horizontal 1"=30' Vertical N/A

Designed JSM Drawn DTC Checked JSM Approved JSM Date 12/13/24

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 barghausen.com

Job Number 21585

Sheet C20 of 44

P:\21000s\21585\engineering\SEPA SET\21585-R.dwg 12/13/2024 11:58 AM DCASEY


PRELIMINARY ROAD IMPROVEMENTS STA 50+00 TO 55+00


OF

FREEMAN LOGISTICS

PTNS. OF THE SE1/4, OF SEC. 17, TWP. 20 N., RGE 4 EAST, W. M.
AND PTNS. OF THE NE1/4, OF SEC. 20, TWP. 20 N., RGE 4 EAST, W. M.
PIERCE COUNTY, WASHINGTON

0 10' 20' 40'
SCALE: 1"=20'

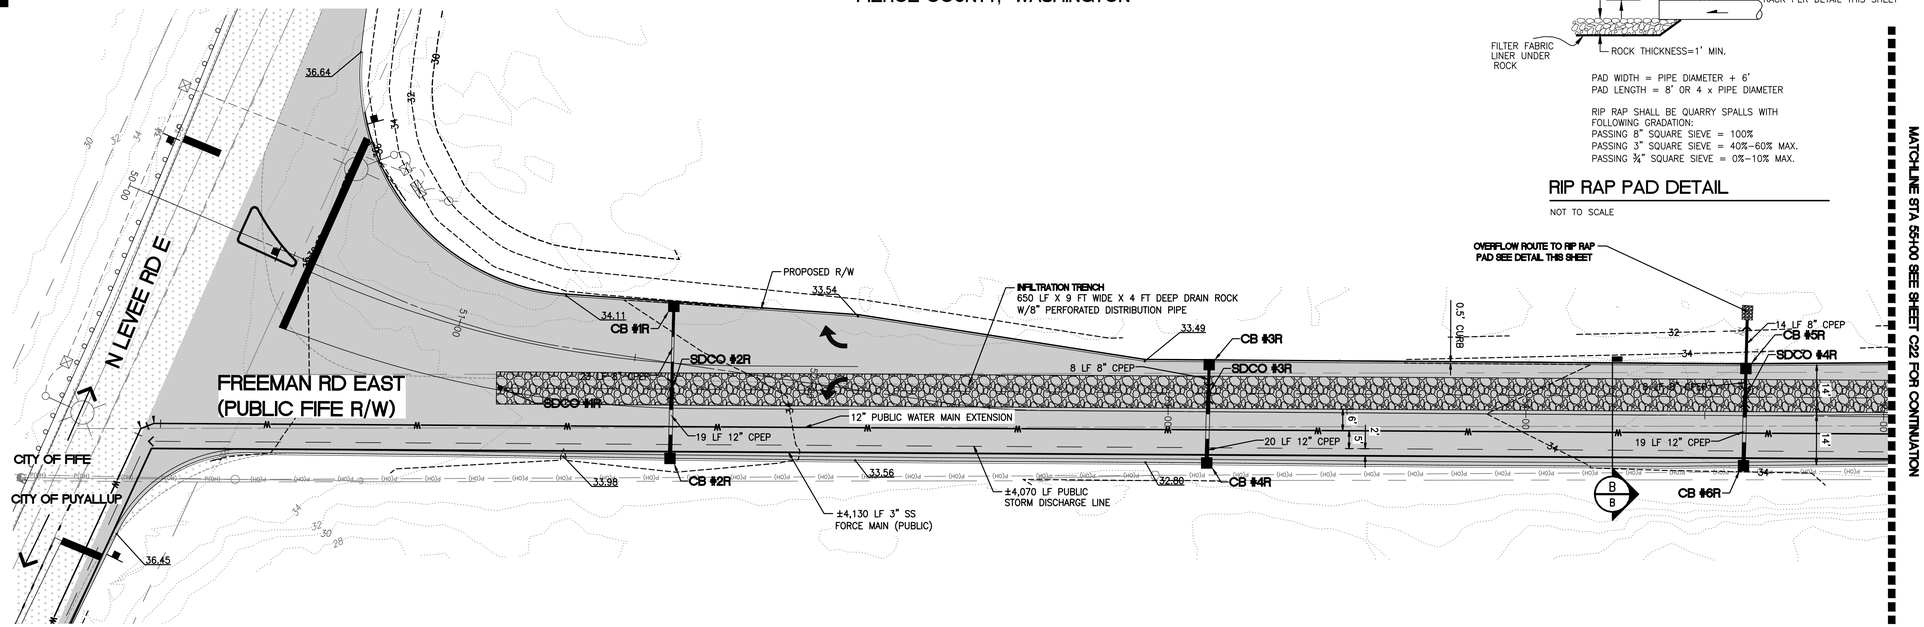

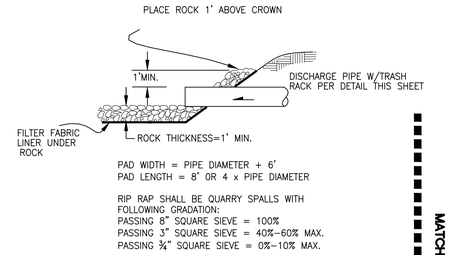



PAD WIDTH = PIPE DIAMETER + 6'
PAD LENGTH = 8' OR 4 x PIPE DIAMETER

RIP RAP SHALL BE QUARRY SPALLS WITH
FOLLOWING GRADATION:
PASSING 8" SQUARE SIEVE = 100%
PASSING 3" SQUARE SIEVE = 40%-60% MAX.
PASSING ¾" SQUARE SIEVE = 0%-10% MAX.

RIP RAP PAD DETAIL

NOT TO SCALE

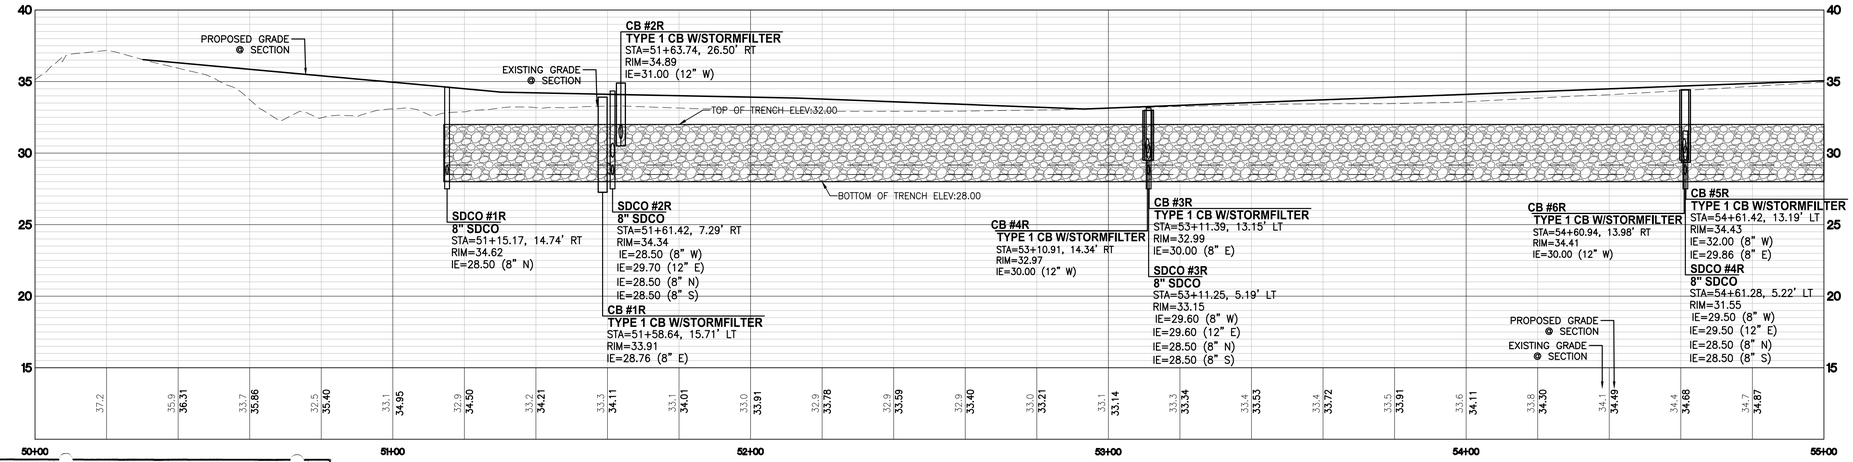

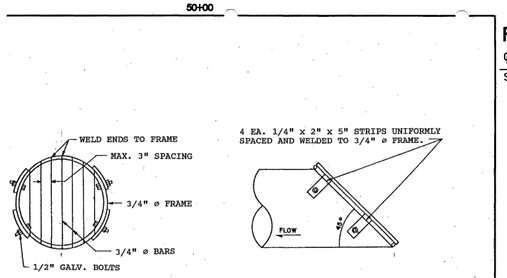


18" AND LARGER PIPE

NOTE: ALL STEEL PARTS TO BE GALVANIZED AND ASPHALT COATED (TREATMENT I OR BETTER).

TRASH RACK DETAIL

FREEMAN ROAD EAST
℄ STA: 50+00 TO 55+00

SCALE: HORIZ. 1"=20' VERT. 1"=5'

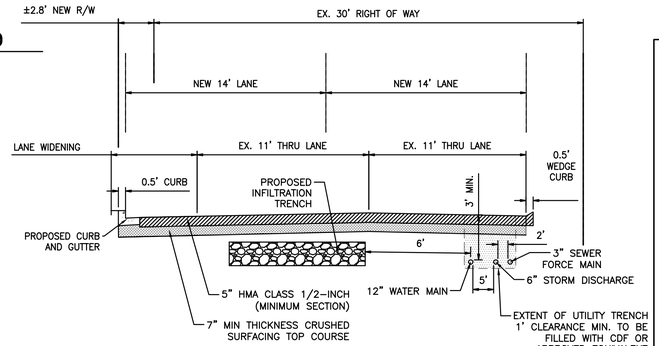

FREEMAN ROAD EAST SECTION B

NOT TO SCALE

FRONTAGE LEGEND:

(NOTE: NOT ALL SYMBOLS MAY APPEAR ON THE MAP)

- TYPE II CATCH BASIN
- TYPE I CATCH BASIN
- STORM DRAIN FLOW ARROW
- STORM DRAINAGE LINE
- FIRE HYDRANT
- WATER VALVE
- CONCRETE BLOCKING
- 90° BEND
- SPOT ELEVATIONS 300.48
- CONTOURS 150
- PROPOSED ASPHALT PAVEMENT
- EXISTING PAVEMENT

ENGINEER'S REVIEW — FIFE

- ☐ APPROVED
- ☐ APPROVED AS CORRECTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED
- ☐ FOR INFORMATION ONLY

THE CITY'S REVIEW IS NOT A CONFIRMATION OF ANY DIMENSION OR QUANTITIES SHOWN IN THE PLANS AND WILL NOT RELIEVE THE DEVELOPER OR ENGINEER FROM RESPONSIBILITY FOR PLANS ERRORS. NO CHANGES SHALL BE MADE TO THE PLANS EXCEPT WITH THE CONSENT OF THE CITY ENGINEER. IF CONSTRUCTION HAS NOT COMMENCED WITHIN A REASONABLE PERIOD OF THE APPROVAL DATE, PLANS WILL REQUIRE RE-APPROVAL BY THE CITY.

BY DATE

CALL BEFORE YOU DIG:
1-800-424-5555

UTILITY CONFLICT NOTE:

CAUTION:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION, DIMENSION, AND DEPTH OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT BY POTHOLING THE UTILITIES AND SURVEYING THE HORIZONTAL AND VERTICAL LOCATION PRIOR TO CONSTRUCTION. THIS SHALL INCLUDE CALLING UTILITY LOCATE @ 1-800-424-5555 AND THEN POTHOLING ALL OF THE EXISTING UTILITIES AT LOCATIONS OF NEW UTILITY CROSSINGS TO PHYSICALLY VERIFY WHETHER OR NOT CONFLICTS EXIST. LOCATIONS OF SAID UTILITIES AS SHOWN ON THESE PLANS ARE BASED UPON THE UNVERIFIED PUBLIC INFORMATION AND ARE SUBJECT TO VARIATION. IF CONFLICTS SHOULD OCCUR, THE CONTRACTOR SHALL CONSULT BARGHAUSEN CONSULTING ENGINEERS, INC. TO RESOLVE ALL PROBLEMS PRIOR TO PROCEEDING WITH CONSTRUCTION.

APPROVED

BY _____
CITY OF PUYALLUP
DEVELOPMENT ENGINEERING

DATE _____

NOTE: THIS APPROVAL IS VOID AFTER 180 DAYS FROM APPROVAL DATE. THE CITY WILL NOT BE RESPONSIBLE FOR ERRORS AND/OR OMISSIONS ON THESE PLANS. FIELD CONDITIONS MAY DICTATE CHANGES TO THESE PLANS AS DETERMINED BY THE DEVELOPMENT ENGINEERING MANAGER.

No.	Date	By	Ckd.	Appr.	Revision
5	12/13/24	DTC	JSM	JSM	SEPA RESUBMITTAL

Title: PRELIMINARY ROAD IMPROVEMENTS
STA 50+00 TO 55+00
FOR
FREEMAN LOGISTICS

For: VECTOR DEVELOPMENT COMPANY
11411 NE 124TH STREET
SUITE 190
KIRKLAND, WA 98034

JASON S. MCKAY — STATE OF WASHINGTON — 24927 — REGISTERED PROFESSIONAL ENGINEER
PRELIMINARY
12/13/24

Scale: Horizontal 1"=20' Vertical 1"=5'
Designed JSM Drawn DTC Checked JSM Approved JSM Date 12/13/24

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222
barghausen.com

Job Number 21585
Sheet C21 of 44

P:\21000s\21585\engineering\SEPA SET\21585-R.dwg 12/13/2024 1:42 PM DCASEY

Appendix B
Study Area Photographs

Appendix B
Study Area Photographs

Photograph 1
Parcels 0420174075 and 0420205016



Photograph 2
Agricultural Ditch



Photograph 3
Agricultural Ditch and Adjacent Agricultural Field




Photograph 4
Adjacent Agricultural Fields



Photograph 5
View of DP1



Photograph 6
Agricultural Ditch South

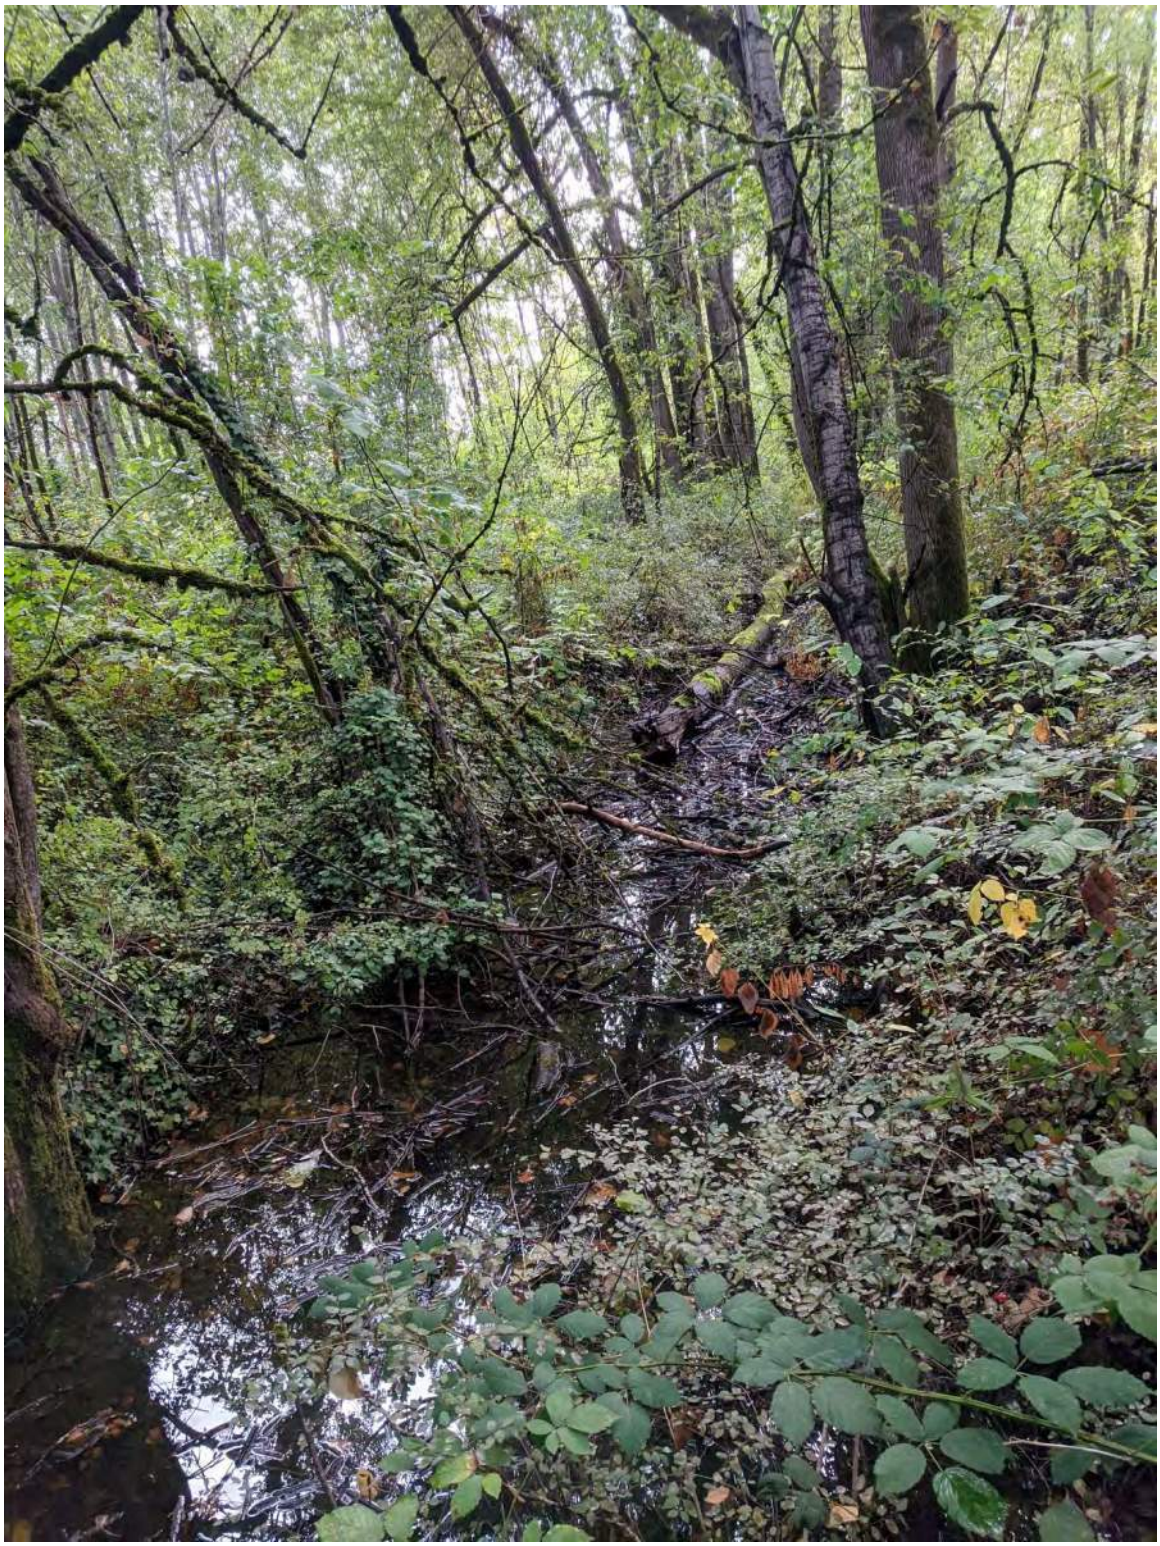

Photograph 7
East Edge of Parcel 0420205016




Photograph 8
Active Grazing in Parcel 0420174075



Photograph 9
Grazing in Parcel 0420174075



Photograph 10
Ditch

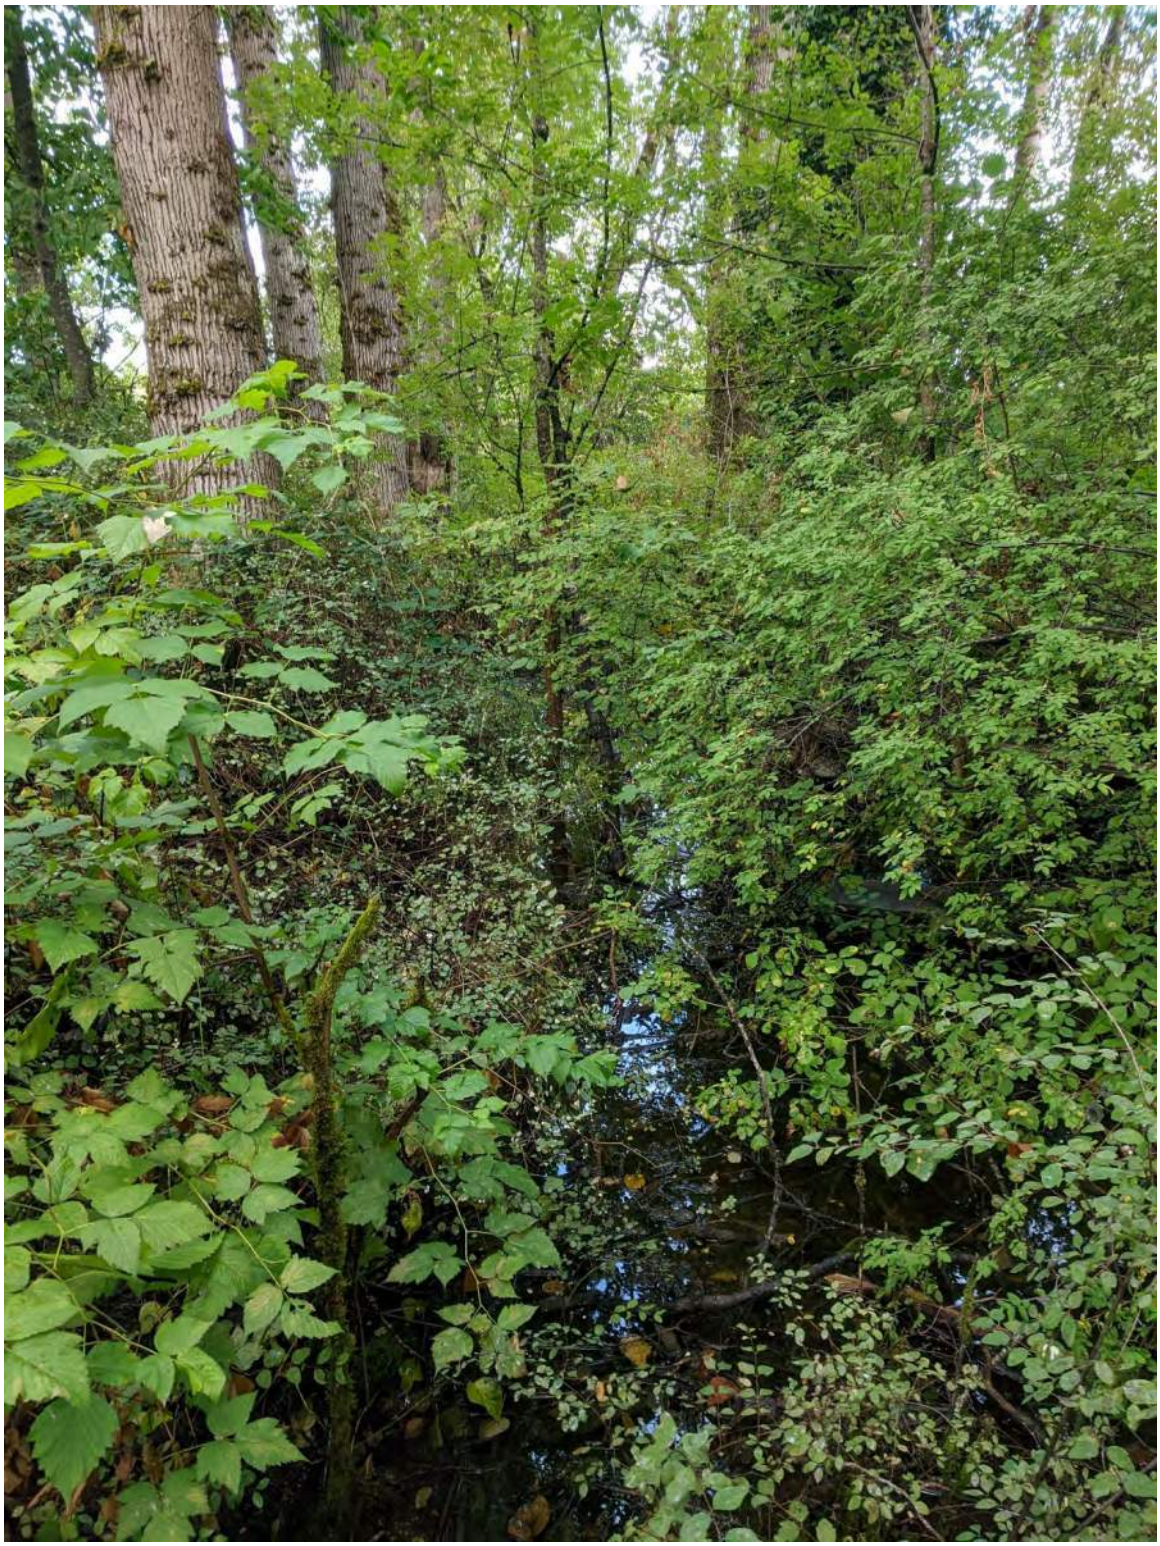

Photograph 11
Field Adjacent to Wetland B



Photograph 12
Landscape View near Wetland B



Photograph 13
View near Wetland B



Photograph 14
Field adjacent to Wetland B



Photograph 15
Area Near Wetland B



Photograph 16
Wetlands Mapped South of 52nd Street East



Photograph 17
Wetlands Mapped South of 52nd Street East



Photograph 18
Vegetation in Wetlands Mapped South of 52nd Street East



Photograph 19
Wetland B on Parcel 0420174075 (March 11, 2022)



Photograph 20
Wetland B on Parcel 0420174075 (March 11, 2022)



Photograph 21
Wetland B on Parcel 0420174075 (March 11, 2022)



Photograph 22
Looking down at Wetland A from the adjacent slope (May 17, 2024)



Photograph 23
Wetland A (May 17, 2024)



Appendix C
Wetland Forms and Figures

Appendix C-1
Data Forms

WETLAND DETERMINATION DATA FORM – Western Mountains, Valleys and Coast Region

Project/Site: Freeman Road Logistics City/County: Puyallup/Pierce County Sampling Date: 3/11/2022
Applicant/Owner: Vector Development Company State: WA Sampling Point: DP-1
Investigator(s): C. Douglas, M. Curran Section, Township, Range: S17 & 20 R4E T20N
Landform (hillslope, terrace, etc.): Forested Local relief (concave, convex, none): concave Slope: 1-5
Subregion (LRR): Northwest Forests and Coast (LRR A) Lat: 47.20922528 Long: -122.3177068 Datum: NAD83
Soil Map Unit Name: Pilchuck fine sand NWI Classification: PFO, PSS, POW
Are climatic / hydrologic conditions on the site typical for this time of year? Yes x No _____ (If no, explain in Remarks)
Are Vegetation _____, Soil _____, or Hydrology _____ significantly disturbed? Are "Normal Circumstances" Present? Yes x No _____
Are Vegetation _____, Soil _____, or Hydrology _____ naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes _____	No **X**	**Is the Sampled Area within a Wetland?** Yes _____ No **X**
Hydric Soil Present?	Yes _____	No **X**	
Wetland Hydrology Present?	Yes **X**	No _____	

Remarks: Delineated northern and eastern boundary of large wetland system to identify potential buffer impacts for utility line construction

VEGETATION

Tree Stratum (Plot size: _____)	Absolute % Cover	Dominant Species?	Indicator Status?
1. *Populus balsamifera ssp. Trichocarpa*	80	Yes	FAC
2. *Picea sitchensis*	10	No	FAC
3.			
4.			
5.			
50%= 45 20%= 18 Total Cover: **90**			
Sapling/Shrub Stratum (Plot size: _____)			
1. *Cornus sericea*	30	No	FACW
2. *Rubus armeniacus*	20	No	FAC
3. *Symphoricarpos albus*	90	Yes	FACU
4. *Ribes sanguineum*	20	No	FACU
5.			
50%= 80 20%= 32 Total Cover: **160**			
Herb Stratum (Plot size: _____)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
50%= 0 20%= 0 Total Cover: **0**			
Woody Vine Stratum (Plot size: _____)			
1. *Hedera helix*	20		FACU
2.			
Total Cover: **20**			
% Bare Ground in Herb Stratum **100** % Cover of Biotic Crust _____			

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: **1** (A)

Total Number of Dominant Species Across All Strata: **2** (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: **50%** (A/B)

Prevalence Index Worksheet:

Total % Cover of:		Multiply by:	
OBL species	**0**	x1 =	**0**
FACW species	**30**	x2 =	**60**
FAC species	**110**	x3 =	**330**
FACU species	**110**	x4 =	**440**
UPL species	**0**	x5 =	**0**
Column Totals:	**250** (A)		**830** (B)

Prevalence Index = B/A = **3.3**

Hydrophytic Vegetation Indicators:

_____ 1 - Rapid Test for Hydrophytic Vegetation
_____ 2 - Dominance Test is >50%
_____ 3 - Prevalence Index is ≤3.0[1]
_____ 4 - Morphological Adaptation[1] (Provide supporting data in Remarks or on a separate sheet)
_____ 5 - Wetland Non-Vascular Plants[1]
_____ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? Yes _____ No **X**

Remarks: 50% FAC vegetation

SOIL

Sampling Point: DP-1

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/2	100					SiL	w/gravel
8-18	10YR 4/2	100					SL	w/gravel

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Muck Mineral (S1)
- ___ Sandy gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) (**except MLRA 1**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR B**)
- ___ Red Parent Material (TF2)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if present):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** _____ **No** **X**

Remarks: 2 chroma with no redox

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum one required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- **x** Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres along Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Plowed Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- ___ Water-Stained Leaves (B9) (**MLRA 1, 2, 4A and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present? Yes _____ No _____ Depth (inches): _____

Water table Present? Yes _____ No _____ Depth (inches): _____

Saturation Present? (includes capillary fringe) Yes **x** No _____ Depth (inches): 10 inches

Wetland Hydrology Present? **Yes** **X** **No** _____

Describe Recorded Data (Unnamed Tributary gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks: Saturation 10 inches deep, no other hydric indicators

WETLAND DETERMINATION DATA FORM – Western Mountains, Valleys and Coast Region

Project/Site: Freeman Road Logistics City/County: Puyallup/Pierce County Sampling Date: 3/11/2022
Applicant/Owner: Vector Development Company State: WA Sampling Point: DP-2
Investigator(s): C. Douglas, M. Curran Section, Township, Range: S17 & 20 R4E T20N
Landform (hillslope, terrace, etc.): Forested Local relief (concave, convex, none): concave Slope: 1-5
Subregion (LRR): Northwest Forests and Coast (LRR A) Lat: 47.2091166 Long: -122.3175633 Datum: NAD83
Soil Map Unit Name: Pilchuck fine sand NWI Classification: PFO, PSS, POW
Are climatic / hydrologic conditions on the site typical for this time of year? Yes x No _____ (If no, explain in Remarks)
Are Vegetation _____, Soil _____, or Hydrology _____ significantly disturbed? Are "Normal Circumstances" Present? Yes x No _____
Are Vegetation _____, Soil _____, or Hydrology _____ naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes **X**	No _____	**Is the Sampled Area within a Wetland?** **Yes X** **No** _____
Hydric Soil Present?	Yes **X**	No _____	
Wetland Hydrology Present?	Yes **X**	No _____	

Remarks: Delineated northern and eastern boundary of large wetland system to identify potential buffer impacts for utility line construction

VEGETATION

Tree Stratum (Plot size: _____)	Absolute % Cover	Dominant Species?	Indicator Status?
1. *Populus balsamifera ssp. Trichocarpa*	70	Yes	FAC
2.			
3.			
4.			
5.			
50%= 35 20%= 14 Total Cover: **70**			
Sapling/Shrub Stratum (Plot size: _____)			
1. *Cornus sericea*	85	Yes	FACW
2. *Rubus armeniacus*	20	No	FAC
3. *Symphoricarpos albus*	20	No	FACU
4.			
5.			
50%= 62.5 20%= 25 Total Cover: **125**			
Herb Stratum (Plot size: _____)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
50%= 0 20%= 0 Total Cover: **0**			
Woody Vine Stratum (Plot size: _____)			
1.			
2.			
Total Cover: **0**			
% Bare Ground in Herb Stratum **100** % Cover of Biotic Crust _____			

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: **2** (A)

Total Number of Dominant Species Across All Strata: **2** (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: **100%** (A/B)

Prevalence Index Worksheet:

Total % Cover of:		Multiply by:	
OBL species	**0**	x1 =	**0**
FACW species	**85**	x2 =	**170**
FAC species	**90**	x3 =	**270**
FACU species	**20**	x4 =	**80**
UPL species	**0**	x5 =	**0**
Column Totals:	**195** (A)		**520** (B)

Prevalence Index = B/A = **2.7**

Hydrophytic Vegetation Indicators:

_____ 1 - Rapid Test for Hydrophytic Vegetation
X 2 - Dominance Test is >50%
X 3 - Prevalence Index is ≤3.0[1]
_____ 4 - Morphological Adaptation[1] (Provide supporting data in Remarks or on a separate sheet)
_____ 5 - Wetland Non-Vascular Plants[1]
_____ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? **Yes X** **No** _____

Remarks: 100% FAC vegetation

SOIL

Sampling Point: DP-2

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-4	10YR 3/1	100					SiL	
4-9	10YR 3/1	90	10YR 5/4	10	D	M	SL	
9-18	10YR 2/1	95	10YR 4/1	5	D	M	LS	w/gravel

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- x Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Muck Mineral (S1)
- ___ Sandy gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) (**except MLRA 1**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR B**)
- ___ Red Parent Material (TF2)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if present):

Type: ___

Depth (inches): ___

Hydric Soil Present? **Yes** X **No** ___

Remarks: 1 chroma with redox

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum one required; check all that apply)

- x Surface Water (A1)
- x High Water Table (A2)
- x Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- x Inundation Visible on Aerial Imagery (B7)
- x Sparsely Vegetated Concave Surface (B8)
- x Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres along Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Plowed Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- x Water-Stained Leaves (B9) (**MLRA 1, 2, 4A and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present? Yes x No ___ Depth (inches): 1 inch

Water table Present? Yes x No ___ Depth (inches): at surface

Saturation Present? (includes capillary fringe) Yes x No ___ Depth (inches): at surface

Wetland Hydrology Present? **Yes** X **No** ___

Describe Recorded Data (Unnamed Tributary gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks: Standing water >1 ft deep 10 ft from DP

WETLAND DETERMINATION DATA FORM – Western Mountains, Valleys and Coast Region

Project/Site: Freeman Road Logistics City/County: Puyallup/Pierce County Sampling Date: 3/11/2022
Applicant/Owner: Vector Development Company State: WA Sampling Point: DP-3
Investigator(s): C. Douglas, M. Curran Section, Township, Range: S17 & 20 R4E T20N
Landform (hillslope, terrace, etc.): Forested Local relief (concave, convex, none): concave Slope: 1-5
Subregion (LRR): Northwest Forests and Coast (LRR A) Lat: 47.20721312 Long: -122.3147837 Datum: NAD83
Soil Map Unit Name: Pilchuck fine sand NWI Classification: PFO, PSS, POW
Are climatic / hydrologic conditions on the site typical for this time of year? Yes x No (If no, explain in Remarks)
Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" Present? Yes x No
Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes **X**	No	
Hydric Soil Present?	Yes	No **X**	**Is the Sampled Area within a Wetland?** Yes	No **X**
Wetland Hydrology Present?	Yes	No **X**	

Remarks: Delineated northern and eastern boundary of large wetland system to identify potential buffer impacts for utility line construction

VEGETATION

Tree Stratum (Plot size:)	Absolute % Cover	Dominant Species?	Indicator Status?
1. *Alnus rubra*	10	No	FAC
2. *Populus balsamifera ssp. Trichocarpa*	60	Yes	FAC
3.			
4.			
5.			
50%= 35 20%= 14 Total Cover:	**70**		
Sapling/Shrub Stratum (Plot size:)			
1. *Oemleria cerasiformis*	30	Yes	FACU
2. *Rubus armeniacus*	70	Yes	FAC
3.			
4.			
5.			
50%= 50 20%= 20 Total Cover:	**100**		
Herb Stratum (Plot size:)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
50%= 0 20%= 0 Total Cover:	**0**		
Woody Vine Stratum (Plot size:)			
1. *Hedera helix*	30		FACU
2.			
Total Cover:	**30**		
% Bare Ground in Herb Stratum **100** % Cover of Biotic Crust			

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: **2** (A)

Total Number of Dominant Species Across All Strata: **3** (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: **67%** (A/B)

Prevalence Index Worksheet:

Total % Cover of:		Multiply by:	
OBL species	**0**	x1 =	**0**
FACW species	**0**	x2 =	**0**
FAC species	**140**	x3 =	**420**
FACU species	**30**	x4 =	**120**
UPL species	**0**	x5 =	**0**
Column Totals:	**170** (A)		**540** (B)

Prevalence Index = B/A = **3.2**

Hydrophytic Vegetation Indicators:

- 1 - Rapid Test for Hydrophytic Vegetation
- **X** 2 - Dominance Test is >50%
- 3 - Prevalence Index is ≤3.0[1]
- 4 - Morphological Adaptation[1] (Provide supporting data in Remarks or on a separate sheet)
- 5 - Wetland Non-Vascular Plants[1]
- Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? Yes **X** No

Remarks: 67% FAC vegetation

SOIL

Sampling Point: DP-3

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-18	10YR 3/3	100					SiL	w/gravel

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Muck Mineral (S1)
- ___ Sandy gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) (**except MLRA 1**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR B**)
- ___ Red Parent Material (TF2)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if present):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** _____ **No** X

Remarks: 3 chroma with no redox

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum one required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres along Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Plowed Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- ___ Water-Stained Leaves (B9) (**MLRA 1, 2, 4A and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present? Yes _____ No _____ Depth (inches): _____

Water table Present? Yes _____ No _____ Depth (inches): _____

Saturation Present? (includes capillary fringe) Yes _____ No _____ Depth (inches): _____

Wetland Hydrology Present? **Yes** _____ **No** X

Describe Recorded Data (Unnamed Tributary gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks: No hydric indicators

WETLAND DETERMINATION DATA FORM – Western Mountains, Valleys and Coast Region

Project/Site: Freeman Road Logistics | City/County: Puyallup/Pierce County | Sampling Date: 3/11/2022
Applicant/Owner: Vector Development Company | State: WA | Sampling Point: DP-4
Investigator(s): C. Douglas, M. Curran | Section, Township, Range: S17 & 20 R4E T20N
Landform (hillslope, terrace, etc.): Forested | Local relief (concave, convex, none): concave | Slope: 1-5
Subregion (LRR): Northwest Forests and Coast (LRR A) | Lat: 47.20725182 | Long: -122.3149014 | Datum: NAD83
Soil Map Unit Name: Pilchuck fine sand | NWI Classification: PFO, PSS, POW
Are climatic / hydrologic conditions on the site typical for this time of year? Yes x No _____ (If no, explain in Remarks)
Are Vegetation _____, Soil _____, or Hydrology _____ significantly disturbed? Are "Normal Circumstances" Present? Yes x No _____
Are Vegetation _____, Soil _____, or Hydrology _____ naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes **X**	No	**Is the Sampled Area within a Wetland?** **Yes X** **No**
Hydric Soil Present?	Yes **X**	No	
Wetland Hydrology Present?	Yes **X**	No	

Remarks: Delineated northern and eastern boundary of large wetland system to identify potential buffer impacts for utility line construction

VEGETATION

Tree Stratum (Plot size:)	Absolute % Cover	Dominant Species?	Indicator Status?
1. *Populus balsamifera ssp. Trichocarpa*	60	Yes	FAC
2.			
3.			
4.			
5.			
50%= 30 20%= 12 Total Cover:	**60**		
Sapling/Shrub Stratum (Plot size:)			
1. *Cornus sericea*	80	Yes	FACW
2. *Rubus armeniacus*	20	No	FAC
3. *Rubus spectabilis*	30	Yes	FAC
4.			
5.			
50%= 65 20%= 26 Total Cover:	**130**		
Herb Stratum (Plot size:)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
50%= 0 20%= 0 Total Cover:	**0**		
Woody Vine Stratum (Plot size:)			
1.			
2.			
Total Cover:	**0**		
% Bare Ground in Herb Stratum **100** % Cover of Biotic Crust			

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: **3** (A)

Total Number of Dominant Species Across All Strata: **3** (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: **100%** (A/B)

Prevalence Index Worksheet:

Total % Cover of:		Multiply by:	
OBL species	**0**	x1 =	**0**
FACW species	**80**	x2 =	**160**
FAC species	**110**	x3 =	**330**
FACU species	**0**	x4 =	**0**
UPL species	**0**	x5 =	**0**
Column Totals:	**190** (A)		**490** (B)

Prevalence Index = B/A = **2.6**

Hydrophytic Vegetation Indicators:

- _____ 1 - Rapid Test for Hydrophytic Vegetation
- **X** 2 - Dominance Test is >50%
- **X** 3 - Prevalence Index is ≤3.0[1]
- _____ 4 - Morphological Adaptation[1] (Provide supporting data in Remarks or on a separate sheet)
- _____ 5 - Wetland Non-Vascular Plants[1]
- _____ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? **Yes X** **No** _____

Remarks: 100% FAC vegetation

SOIL

Sampling Point: DP-4

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-5	10YR 3/1	100					SiL	
5-18	10YR 4/1	85	10YR 5/4	15	D	M	SiL	

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- x Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Muck Mineral (S1)
- ___ Sandy gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) (**except MLRA 1**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR B**)
- ___ Red Parent Material (TF2)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if present):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** _____

Remarks: 1 chroma with redox

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum one required; check all that apply)

- ___ Surface Water (A1)
- x High Water Table (A2)
- x Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- x Inundation Visible on Aerial Imagery (B7)
- x Sparsely Vegetated Concave Surface (B8)
- x Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- x Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres along Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Plowed Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- x Water-Stained Leaves (B9) (**MLRA 1, 2, 4A and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present? Yes _____ No x Depth (inches): _____

Water table Present? Yes x No _____ Depth (inches): at surface

Saturation Present? (includes capillary fringe) Yes x No _____ Depth (inches): at surface

Wetland Hydrology Present? **Yes** X **No** _____

Describe Recorded Data (Unnamed Tributary gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks: Standing water >1 ft deep 3 ft from DP

WETLAND DETERMINATION DATA FORM – Western Mountains, Valleys and Coast Region

Project/Site: Freeman Road Logistics City/County: Puyallup/Pierce County Sampling Date: 3/11/2022
Applicant/Owner: Vector Development Company State: WA Sampling Point: DP-5
Investigator(s): C. Douglas, M. Curran Section, Township, Range: S17 & 20 R4E T20N
Landform (hillslope, terrace, etc.): Forested Local relief (concave, convex, none): concave Slope: 1-5
Subregion (LRR): Northwest Forests and Coast (LRR A) Lat: 47.20693991 Long: -122.3150232 Datum: NAD83
Soil Map Unit Name: Pilchuck fine sand NWI Classification: PFO, PSS, POW
Are climatic / hydrologic conditions on the site typical for this time of year? Yes x No (If no, explain in Remarks)
Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" Present? Yes x No
Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No	**X**
Hydric Soil Present?	Yes	No	**X**
Wetland Hydrology Present?	Yes	No	**X**

Is the Sampled Area within a Wetland? **Yes** **No** **X**

Remarks: Delineated northern and eastern boundary of large wetland system to identify potential buffer impacts for utility line construction

VEGETATION

	Absolute % Cover	Dominant Species?	Indicator Status?
Tree Stratum (Plot size:)			
1. *Alnus rubra*	60	Yes	FAC
2. *Populus balsamifera ssp. Trichocarpa*	80	Yes	FAC
3.			
4.			
5.			
50%= 70 20%= 28 Total Cover: **140**			
Sapling/Shrub Stratum (Plot size:)			
1. *Oemleria cerasiformis*	50	Yes	FACU
2. *Rubus armeniacus*	10	No	FAC
3. *Rubus spectabilis*	20	No	FAC
4. *Symphoricarpos albus*	70	Yes	FACU
5.			
50%= 75 20%= 30 Total Cover: **150**			
Herb Stratum (Plot size:)			
1. *Polystichum munitum*	20	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
50%= 10 20%= 4 Total Cover: **20**			
Woody Vine Stratum (Plot size:)			
1. *Hedera helix*	20		FACU
2.			
Total Cover: **20**			
% Bare Ground in Herb Stratum **80** % Cover of Biotic Crust			

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: **2** (A)

Total Number of Dominant Species Across All Strata: **5** (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: **40%** (A/B)

Prevalence Index Worksheet:

Total % Cover of:		Multiply by:	
OBL species	**0**	x1 =	**0**
FACW species	**0**	x2 =	**0**
FAC species	**170**	x3 =	**510**
FACU species	**140**	x4 =	**560**
UPL species	**0**	x5 =	**0**
Column Totals:	**310** (A)		**1070** (B)

Prevalence Index = B/A = **3.5**

Hydrophytic Vegetation Indicators:

- 1 - Rapid Test for Hydrophytic Vegetation
- 2 - Dominance Test is >50%
- 3 - Prevalence Index is ≤3.0[1]
- 4 - Morphological Adaptation[1] (Provide supporting data in Remarks or on a separate sheet)
- 5 - Wetland Non-Vascular Plants[1]
- Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? **Yes** **No** **X**

Remarks: 40% FAC vegetation

SOIL

Sampling Point: DP-5

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-18	10YR 3/3	100					L	

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Muck Mineral (S1)
- ___ Sandy gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) (**except MLRA 1**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR B**)
- ___ Red Parent Material (TF2)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if present):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** _____ **No** **X**

Remarks: 3 chroma with no redox

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum one required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres along Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Plowed Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- ___ Water-Stained Leaves (B9) (**MLRA 1, 2, 4A and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present? Yes _____ No _____ Depth (inches): _____

Water table Present? Yes _____ No _____ Depth (inches): _____

Saturation Present? (includes capillary fringe) Yes _____ No _____ Depth (inches): _____

Wetland Hydrology Present? **Yes** _____ **No** **X**

Describe Recorded Data (Unnamed Tributary gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks: No hydric indicators

WETLAND DETERMINATION DATA FORM – Western Mountains, Valleys and Coast Region

Project/Site: Freeman Road Logistics City/County: Puyallup/Pierce County Sampling Date: 3/11/2022
Applicant/Owner: Vector Development Company State: WA Sampling Point: DP-6
Investigator(s): C. Douglas, M. Curran Section, Township, Range: S17 & 20 R4E T20N
Landform (hillslope, terrace, etc.): Forested Local relief (concave, convex, none): concave Slope: 1-5
Subregion (LRR): Northwest Forests and Coast (LRR A) Lat: 47.20715552 Long: -122.3151651 Datum: NAD83
Soil Map Unit Name: Pilchuck fine sand NWI Classification: PFO, PSS, POW
Are climatic / hydrologic conditions on the site typical for this time of year? Yes x No (If no, explain in Remarks)
Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" Present? Yes x No
Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present? Yes **X** No
Hydric Soil Present? Yes **X** No
Wetland Hydrology Present? Yes **X** No

Is the Sampled Area within a Wetland? **Yes X** **No**

Remarks: Delineated northern and eastern boundary of large wetland system to identify potential buffer impacts for utility line construction

VEGETATION

Tree Stratum (Plot size:)	Absolute % Cover	Dominant Species?	Indicator Status?
1. *Alnus rubra*	70	Yes	FAC
2. *Populus balsamifera ssp. Trichocarpa*	20	Yes	FAC
3.			
4.			
5.			
50%= 45 20%= 18 Total Cover:	**90**		
Sapling/Shrub Stratum (Plot size:)			
1. *Cornus sericea*	70	Yes	FACW
2. *Rubus armeniacus*	20	No	FAC
3. *Rubus spectabilis*	20	No	FAC
4. *Ribes sanguineum*	5	No	FACU
5. *Symphoricarpos albus*	5	No	FACU
50%= 60 20%= 24 Total Cover:	**120**		
Herb Stratum (Plot size:)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
50%= 0 20%= 0 Total Cover:	**0**		
Woody Vine Stratum (Plot size:)			
1.			
2.			
Total Cover:	**0**		
% Bare Ground in Herb Stratum **100** % Cover of Biotic Crust			

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: **3** (A)

Total Number of Dominant Species Across All Strata: **3** (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: **100%** (A/B)

Prevalence Index Worksheet:

Total % Cover of:		Multiply by:	
OBL species	**0**	x1 =	**0**
FACW species	**70**	x2 =	**140**
FAC species	**130**	x3 =	**390**
FACU species	**10**	x4 =	**40**
UPL species	**0**	x5 =	**0**
Column Totals:	**210** (A)		**570** (B)

Prevalence Index = B/A = **2.7**

Hydrophytic Vegetation Indicators:

- 1 - Rapid Test for Hydrophytic Vegetation
- **X** 2 - Dominance Test is >50%
- **X** 3 - Prevalence Index is ≤3.0[1]
- 4 - Morphological Adaptation[1] (Provide supporting data in Remarks or on a separate sheet)
- 5 - Wetland Non-Vascular Plants[1]
- Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? **Yes X** **No**

Remarks: 100% FAC vegetation

SOIL

Sampling Point: DP-6

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-4	10YR 3/1	100					SiL	
4-18	10YR 4/1	80	10YR 5/4	20	D	M	SiL	

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- x Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Muck Mineral (S1)
- ___ Sandy gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) (**except MLRA 1**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR B**)
- ___ Red Parent Material (TF2)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if present):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** _____

Remarks: 1 chroma with redox

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum one required; check all that apply)

- x Surface Water (A1)
- x High Water Table (A2)
- x Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- x Inundation Visible on Aerial Imagery (B7)
- x Sparsely Vegetated Concave Surface (B8)
- x Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- x Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres along Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Plowed Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- x Water-Stained Leaves (B9) (**MLRA 1, 2, 4A and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present? Yes x No ___ Depth (inches): 1 inch

Water table Present? Yes x No ___ Depth (inches): at surface

Saturation Present? (includes capillary fringe) Yes x No ___ Depth (inches): at surface

Wetland Hydrology Present? **Yes** X **No** _____

Describe Recorded Data (Unnamed Tributary gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks: Standing water >1 ft deep 2 ft from DP

U.S. Army Corps of Engineers

WETLAND DETERMINATION DATA SHEET – Western Mountains, Valleys, and Coast Region

See ERDC/EL TR-10-3; the proponent agency is CECW-CO-R

OMB Control #: 0710-0024, Exp: 11/30/2024
Requirement Control Symbol EXEMPT:
(Authority: AR 335-15, paragraph 5-2a)

Project/Site: Vector Freeman/5203 Freeman Rd E | City/County: Puyallup/Pierce | Sampling Date: 5/17

Applicant/Owner: Vector/Puyallup Tribe | State: WA | Sampling Point: DP-7

Investigator(s): Hannah Fotherby | Section, Township, Range: S20, T20N, R4E

Landform (hillside, terrace, etc.): floodplain/historic river meander | Local relief (concave, convex, none): none | Slope (%): 5

Subregion (LRR): LRR A, MLRA 2 | Lat: 47.20858637 | Long: -122.3197029 | Datum: WGS84

Soil Map Unit Name: Pilchuck fine sand | NWI classification: PFO1C

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No ____ (If no, explain in Remarks.)

Are Vegetation ____, Soil ____, or Hydrology ____ significantly disturbed? Are "Normal Circumstances" present? Yes X No ____

Are Vegetation ____, Soil ____, or Hydrology ____ naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present? Yes X No ____

Hydric Soil Present? Yes ____ No X

Wetland Hydrology Present? Yes ____ No X

Is the Sampled Area within a Wetland? **Yes** ____ **No** X

Remarks:
Plot located in a flat area below the line of Symphoricarpos albus, where the Populus balsamifera community transitions to a Cornus alba community.

VEGETATION – Use scientific names of plants.

	Absolute % Cover	Dominant Species?	Indicator Status
Tree Stratum (Plot size: 30)			
1. *Populus balsamifera*	60	Yes	FAC
2. *Prunus emarginata*	10	No	FACU
3.			
4.			
	70	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15)			
1. *Cornus alba*	20	Yes	FACW
2. *Symphoricarpos albus*	15	Yes	FACU
3.			
4.			
5.			
	35	=Total Cover	
Herb Stratum (Plot size: 5)			
1. *Urtica dioica*	2	No	FAC
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
	2	=Total Cover	
Woody Vine Stratum (Plot size: 15)			
1.			
2.			
		=Total Cover	

% Bare Ground in Herb Stratum 98

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 66.7% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	20	x 2 =	40
FAC species	62	x 3 =	186
FACU species	25	x 4 =	100
UPL species	0	x 5 =	0
Column Totals:	107 (A)		326 (B)

Prevalence Index = B/A = 3.05

Hydrophytic Vegetation Indicators:

____ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

____ 3 - Prevalence Index is ≤3.0[1]

____ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

____ 5 - Wetland Non-Vascular Plants[1]

____ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? **Yes** X **No** ____

Remarks:

SOIL

Sampling Point: DP-7

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-6	10YR 2/1	100					Sandy	sandy loam
6-18	10YR 3/1	100					Sandy	loamy sand (mostly sand)

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ 1 cm Muck (A9) **(LRR D, G)**
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ 2.5 cm Mucky Peat or Peat (S2) **(LRR G)**
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) **(except MLRA 1)**
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) **(LRR A, E)**
- ___ Iron-Manganese Masses (F12) **(LRR D)**
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (F22)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

No redox or hydrogen sulfide smell observed. Sand composition increases with depth.

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A, and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- ___ Water-Stained Leaves (B9) (**MLRA 1, 2 4A, and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- X Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present?	Yes ___	No X	Depth (inches): ___
Water Table Present?	Yes ___	No X	Depth (inches): ___
Saturation Present? (includes capillary fringe)	Yes ___	No X	Depth (inches): ___

Wetland Hydrology Present? **Yes** ___ **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

Soil plug was moist but not saturated. Geomorphic position is a flat area adjacent to a ponded depression.

U.S. Army Corps of Engineers

WETLAND DETERMINATION DATA SHEET – Western Mountains, Valleys, and Coast Region

See ERDC/EL TR-10-3; the proponent agency is CECW-CO-R

OMB Control #: 0710-0024, Exp: 11/30/2024
Requirement Control Symbol EXEMPT:
(Authority: AR 335-15, paragraph 5-2a)

Project/Site: Vector Freeman/5203 Freeman Rd E City/County: Puyallup/Pierce Sampling Date: 5/17/24

Applicant/Owner: Vector/Puyallup Tribe State: WA Sampling Point: DP-8

Investigator(s): Hannah Fotherby Section, Township, Range: S20, T20N. R4E

Landform (hillside, terrace, etc.): floodplain/historic river meander Local relief (concave, convex, none): none Slope (%): 1

Subregion (LRR): LRR A, MLRA 2 Lat: 47.20861737 Long: -122.3197029 Datum: WGS84

Soil Map Unit Name: Pilchuck fine sand NWI classification: PFO1C

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No ____ (If no, explain in Remarks.)

Are Vegetation ____, Soil ____, or Hydrology ____ significantly disturbed? Are "Normal Circumstances" present? Yes X No ____

Are Vegetation ____, Soil ____, or Hydrology ____ naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present? Yes X No ____

Hydric Soil Present? Yes X No ____

Wetland Hydrology Present? Yes X No ____

Is the Sampled Area within a Wetland? **Yes** X **No** ____

Remarks:
Plot is approximately 1 foot lower in elevation than DP-7, and approximately 15 feet away.

VEGETATION – Use scientific names of plants.

Tree Stratum (Plot size: 30)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Fraxinus latifolia*	30	Yes	FACW
2.			
3.			
4.			
	30	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15)			
1. *Cornus alba*	95	Yes	FACW
2.			
3.			
4.			
5.			
	95	=Total Cover	
Herb Stratum (Plot size: 5)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
		=Total Cover	
Woody Vine Stratum (Plot size: 15)			
1.			
2.			
		=Total Cover	

% Bare Ground in Herb Stratum 100

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 2 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	125	x 2 =	250
FAC species	0	x 3 =	0
FACU species	0	x 4 =	0
UPL species	0	x 5 =	0
Column Totals:	125 (A)		250 (B)

Prevalence Index = B/A = 2.00

Hydrophytic Vegetation Indicators:

____ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

X 3 - Prevalence Index is ≤3.0[1]

____ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

____ 5 - Wetland Non-Vascular Plants[1]

____ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? **Yes** X **No** ____

Remarks:

SOIL

Sampling Point: DP-8

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	Matrix %	Redox Features Color (moist)	Redox Features %	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 2/1	100					Mucky Sand	contains silt
8-18	10YR 2/1	100					Sandy	

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- X Hydrogen Sulfide (A4)
- ___ 1 cm Muck (A9) **(LRR D, G)**
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- X Sandy Mucky Mineral (S1)
- ___ 2.5 cm Mucky Peat or Peat (S2) **(LRR G)**
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) **(except MLRA 1)**
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) **(LRR A, E)**
- ___ Iron-Manganese Masses (F12) **(LRR D)**
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (F22)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

Sand composition increases with depth. Hydrogen sulfide odor.

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A, and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- X Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- ___ Water-Stained Leaves (B9) (**MLRA 1, 2 4A, and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- X Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- X FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present?	Yes ___	No X	Depth (inches): ___
Water Table Present?	Yes X	No ___	Depth (inches): 4
Saturation Present? (includes capillary fringe)	Yes X	No ___	Depth (inches): 0

Wetland Hydrology Present? **Yes** X **No** ___

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

Surface water was approximately 15 feet away from plot. Geomorphic position is a flat area within a depression.

U.S. Army Corps of Engineers

WETLAND DETERMINATION DATA SHEET – Western Mountains, Valleys, and Coast Region

See ERDC/EL TR-10-3; the proponent agency is CECW-CO-R

OMB Control #: 0710-0024, Exp: 11/30/2024
Requirement Control Symbol EXEMPT:
(Authority: AR 335-15, paragraph 5-2a)

Project/Site: Vector Freeman/5203 Freeman Rd E | City/County: Puyallup/Pierce | Sampling Date: 5/17/24

Applicant/Owner: Vector/Puyallup Tribe | State: WA | Sampling Point: DP-9

Investigator(s): Hannah Fotherby | Section, Township, Range: S20, T20N, R4E

Landform (hillside, terrace, etc.): floodplain/historic river meander | Local relief (concave, convex, none): convex | Slope (%): 8

Subregion (LRR): LRR A, MLRA 2 | Lat: 47.20862474 | Long: -122.3201188 | Datum: WGS84

Soil Map Unit Name: Pilchuck fine sand | NWI classification: PFO1C

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No ____ (If no, explain in Remarks.)

Are Vegetation ____, Soil ____, or Hydrology ____ significantly disturbed? Are "Normal Circumstances" present? Yes X No ____

Are Vegetation ____, Soil ____, or Hydrology ____ naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present? Yes X No ____

Hydric Soil Present? Yes ____ No X

Wetland Hydrology Present? Yes ____ No X

Is the Sampled Area within a Wetland? **Yes** ____ **No** X

Remarks:
Plot located on a slope, at the base of a large black cottonwood. Plot is approximately 8 feet higher on the slope than DP-10.

VEGETATION – Use scientific names of plants.

	Absolute % Cover	Dominant Species?	Indicator Status
Tree Stratum (Plot size: 30)			
1. *Populus balsamifera*	75	Yes	FAC
2. *Prunus emarginata*	15	No	FACU
3. *Fraxinus latifolia*	10	No	FACW
4.			
	100	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15)			
1. *Symphoricarpos albus*	70	Yes	FACU
2. *Physocarpus capitatus*	30	Yes	FACW
3.			
4.			
5.			
	100	=Total Cover	
Herb Stratum (Plot size: 5)			
1. *Urtica dioica*	5	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
	5	=Total Cover	
Woody Vine Stratum (Plot size: 15)			
1.			
2.			
		=Total Cover	

% Bare Ground in Herb Stratum 95

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 75.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	40	x 2 =	80
FAC species	80	x 3 =	240
FACU species	85	x 4 =	340
UPL species	0	x 5 =	0
Column Totals:	205 (A)		660 (B)

Prevalence Index = B/A = 3.22

Hydrophytic Vegetation Indicators:

____ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

____ 3 - Prevalence Index is ≤3.0[1]

____ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

____ 5 - Wetland Non-Vascular Plants[1]

____ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? **Yes** X **No** ____

Remarks:

SOIL

Sampling Point: DP-9

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-10	10YR 3/2	100					Sandy	sandy loam
10-18	10YR 3/2	100					Sandy	loamy sand

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ 1 cm Muck (A9) **(LRR D, G)**
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ 2.5 cm Mucky Peat or Peat (S2) **(LRR G)**
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) **(except MLRA 1)**
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) **(LRR A, E)**
- ___ Iron-Manganese Masses (F12) **(LRR D)**
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (F22)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

Sand composition increases with depth. No redox observed.

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A, and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- ___ Water-Stained Leaves (B9) (**MLRA 1, 2 4A, and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present? Yes ___ No X Depth (inches): ___

Water Table Present? Yes ___ No X Depth (inches): ___

Saturation Present? (includes capillary fringe) Yes ___ No X Depth (inches): ___

Wetland Hydrology Present? **Yes** ___ **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

Soil plug was very lightly moist but not saturated.

U.S. Army Corps of Engineers

WETLAND DETERMINATION DATA SHEET – Western Mountains, Valleys, and Coast Region

See ERDC/EL TR-10-3; the proponent agency is CECW-CO-R

OMB Control #: 0710-0024, Exp: 11/30/2024
Requirement Control Symbol EXEMPT:
(Authority: AR 335-15, paragraph 5-2a)

Project/Site: Vector Freeman/5203 Freeman Rd E | City/County: Puyallup/Pierce | Sampling Date: 5/17/24

Applicant/Owner: Vector/Puyallup Tribe | State: WA | Sampling Point: DP-10

Investigator(s): Hannah Fotherby | Section, Township, Range: S20, T20N, R4E

Landform (hillside, terrace, etc.): floodplain/historic river meander | Local relief (concave, convex, none): concave | Slope (%): 10

Subregion (LRR): LRR A, MLRA 2 | Lat: 47.20869074 | Long: -122.3200738 | Datum: WGS84

Soil Map Unit Name: Pilchuck fine sand | NWI classification: PFO1C

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No ____ (If no, explain in Remarks.)

Are Vegetation ____, Soil ____, or Hydrology ____ significantly disturbed? Are "Normal Circumstances" present? Yes X No ____

Are Vegetation ____, Soil ____, or Hydrology ____ naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present? Yes X No ____

Hydric Soil Present? Yes X No ____

Wetland Hydrology Present? Yes X No ____

Is the Sampled Area within a Wetland? **Yes** X **No** ____

Remarks:
Plot located at the edge of the ponded area within Wetland A. At the toe of slope and within a depression.

VEGETATION – Use scientific names of plants.

Tree Stratum (Plot size: 30)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Populus balsamifera*	60	Yes	FAC
2.			
3.			
4.			
	60	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15)			
1. *Cornus sericea*	80	Yes	FACW
2.			
3.			
4.			
5.			
	80	=Total Cover	
Herb Stratum (Plot size: 5)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
		=Total Cover	
Woody Vine Stratum (Plot size: 15)			
1.			
2.			
		=Total Cover	

% Bare Ground in Herb Stratum 100

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 2 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	80	x 2 =	160
FAC species	60	x 3 =	180
FACU species	0	x 4 =	0
UPL species	0	x 5 =	0
Column Totals:	140 (A)		340 (B)

Prevalence Index = B/A = 2.43

Hydrophytic Vegetation Indicators:

____ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

X 3 - Prevalence Index is ≤3.0[1]

____ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

____ 5 - Wetland Non-Vascular Plants[1]

____ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? **Yes** X **No** ____

Remarks:

SOIL

Sampling Point: DP-10

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-5	10YR 2/1	100					Mucky Sand	

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- X Hydrogen Sulfide (A4)
- ___ 1 cm Muck (A9) **(LRR D, G)**
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- X Sandy Mucky Mineral (S1)
- ___ 2.5 cm Mucky Peat or Peat (S2) **(LRR G)**
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) **(except MLRA 1)**
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) **(LRR A, E)**
- ___ Iron-Manganese Masses (F12) **(LRR D)**
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (F22)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

Could not dig deeper than 5 inches due to roots. Faint hydrogen sulfide odor.

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A, and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- X Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- ___ Water-Stained Leaves (B9) (**MLRA 1, 2 4A, and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- X Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- X FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present?	Yes ___	No X	Depth (inches): ___
Water Table Present?	Yes X	No ___	Depth (inches): 2
Saturation Present? (includes capillary fringe)	Yes X	No ___	Depth (inches): 0

Wetland Hydrology Present? **Yes** X **No** ___

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

Permanent ponding is approximately 5 feet from this plot location. Geomorphic position is at the toe of slope and within a depression.

U.S. Army Corps of Engineers

WETLAND DETERMINATION DATA SHEET – Western Mountains, Valleys, and Coast Region

See ERDC/EL TR-10-3; the proponent agency is CECW-CO-R

OMB Control #: 0710-0024, Exp: 11/30/2024
Requirement Control Symbol EXEMPT:
(Authority: AR 335-15, paragraph 5-2a)

Project/Site: Vector Freeman/5203 Freeman Rd E | City/County: Puyallup/Pierce | Sampling Date: 5/17/24

Applicant/Owner: Vector/Puyallup Tribe | State: WA | Sampling Point: DP-11

Investigator(s): Hannah Fotherby | Section, Township, Range: S20, T20N, R4E

Landform (hillside, terrace, etc.): historic floodplain | Local relief (concave, convex, none): concave | Slope (%): 10

Subregion (LRR): LRR A, MLRA 2 | Lat: 47.208145 | Long: -122.319899 | Datum: WGS84

Soil Map Unit Name: Pilchuck fine sand | NWI classification: none

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No ____ (If no, explain in Remarks.)

Are Vegetation ____, Soil ____, or Hydrology ____ significantly disturbed? Are "Normal Circumstances" present? Yes X No ____

Are Vegetation ____, Soil ____, or Hydrology ____ naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present? Yes ____ No X

Hydric Soil Present? Yes ____ No X

Wetland Hydrology Present? Yes ____ No X

Is the Sampled Area within a Wetland? **Yes** ____ **No** X

Remarks:
Plot located in a low area between Wetland A and the intersection of Levee Rd and Freeman Rd E.

VEGETATION – Use scientific names of plants.

Tree Stratum (Plot size: 30)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Populus balsamifera*	50	Yes	FAC
2. *Acer macrophyllum*	30	Yes	FACU
3. *Prunus emarginata*	10	No	FACU
4.			
	90	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15)			
1. *Symphoricarpos albus*	65	Yes	FACU
2. *Oemleria cerasiformis*	30	Yes	FACU
3. *Rubus armeniacus*	2	No	FAC
4.			
5.			
	97	=Total Cover	
Herb Stratum (Plot size: 5)			
1. *Urtica dioica*	20	Yes	FAC
2. *Polystichum munitum*	5	No	FACU
3. *Galium aparine*	2	No	FACU
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
	27	=Total Cover	
Woody Vine Stratum (Plot size: ____)			
1.			
2.			
	____	=Total Cover	

% Bare Ground in Herb Stratum 73

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 40.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	72	x 3 =	216
FACU species	142	x 4 =	568
UPL species	0	x 5 =	0
Column Totals:	214 (A)		784 (B)
Prevalence Index = B/A =			3.66

Hydrophytic Vegetation Indicators:

____ 1 - Rapid Test for Hydrophytic Vegetation

____ 2 - Dominance Test is >50%

____ 3 - Prevalence Index is ≤3.0[1]

____ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

____ 5 - Wetland Non-Vascular Plants[1]

____ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? **Yes** ____ **No** X

Remarks:

SOIL

Sampling Point: DP-11

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	Matrix %	Redox Features Color (moist)	Redox Features %	Type[1]	Loc[2]	Texture	Remarks
0-18	10YR 3/2	100					Loamy/Clayey	

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ 1 cm Muck (A9) **(LRR D, G)**
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ 2.5 cm Mucky Peat or Peat (S2) **(LRR G)**
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) **(except MLRA 1)**
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) **(LRR A, E)**
- ___ Iron-Manganese Masses (F12) **(LRR D)**
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (F22)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:
No redox features observed.

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A, and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- ___ Water-Stained Leaves (B9) (**MLRA 1, 2 4A, and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present? Yes ___ No X Depth (inches): ___

Water Table Present? Yes ___ No X Depth (inches): ___

Saturation Present? (includes capillary fringe) Yes ___ No X Depth (inches): ___

Wetland Hydrology Present? **Yes** ___ **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:
Soil plug was dry.

U.S. Army Corps of Engineers

WETLAND DETERMINATION DATA SHEET – Western Mountains, Valleys, and Coast Region

See ERDC/EL TR-10-3; the proponent agency is CECW-CO-R

OMB Control #: 0710-0024, Exp: 11/30/2024
Requirement Control Symbol EXEMPT:
(Authority: AR 335-15, paragraph 5-2a)

Project/Site: Freeman Road - Parcel 0420201104 City/County: Fife/Pierce Sampling Date: 5/20/23

Applicant/Owner: Vector Development State: WA Sampling Point: DP-12

Investigator(s): Hannah Fotherby and Jakob Rowny Section, Township, Range: S20, T20N, R04E

Landform (hillside, terrace, etc.): Ditch/trench bottom Local relief (concave, convex, none): concave Slope (%): 0

Subregion (LRR): LRR A, MLRA 2 Lat: 47.2085448 Long: -122.32171 Datum: WGS84

Soil Map Unit Name: Pilchuck fine sand NWI classification: none

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No ____ (If no, explain in Remarks.)

Are Vegetation ____, Soil ____, or Hydrology ____ significantly disturbed? Are "Normal Circumstances" present? Yes X No ____

Are Vegetation ____, Soil ____, or Hydrology ____ naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No ____	**Is the Sampled Area within a Wetland?** Yes ____ No X
Hydric Soil Present?	Yes ____	No X	
Wetland Hydrology Present?	Yes ____	No X	

Remarks:
Data point located in a low area in the northeast portion of the parcel, within a small trench/ditch about 3 feet deep.

VEGETATION – Use scientific names of plants.

Tree Stratum (Plot size: 30)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Populus balsamifera*	75	Yes	FAC
2. *Acer macrophyllum*	15	No	FACU
3.			
4.			
	90	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15)			
1. *Symphoricarpos albus*	40	Yes	FACU
2. *Corylus cornuta*	30	Yes	FACU
3. *Fraxinus latifolia*	30	Yes	FACW
4. *Rubus armeniacus*	15	No	FAC
5.			
	115	=Total Cover	
Herb Stratum (Plot size: 5)			
1. *Ranunculus repens*	10	Yes	FAC
2. *Rubus ursinus*	5	Yes	FACU
3. Unknown grass sp.	5	Yes	FAC
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
	20	=Total Cover	
Woody Vine Stratum (Plot size: 15)			
1.			
2.			
		=Total Cover	

% Bare Ground in Herb Stratum 80

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 4 (A)

Total Number of Dominant Species Across All Strata: 7 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 57.1% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	30	x 2 =	60
FAC species	105	x 3 =	315
FACU species	90	x 4 =	360
UPL species	0	x 5 =	0
Column Totals:	225 (A)		735 (B)

Prevalence Index = B/A = 3.27

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ 5 - Wetland Non-Vascular Plants[1]

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? Yes X No ____

Remarks:

SOIL

Sampling Point: DP-12

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-18	10YR 3/3	100					Sandy	sandy loam

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

___ Histosol (A1)
___ Histic Epipedon (A2)
___ Black Histic (A3)
___ Hydrogen Sulfide (A4)
___ 1 cm Muck (A9) **(LRR D, G)**
___ Depleted Below Dark Surface (A11)
___ Thick Dark Surface (A12)
___ Sandy Mucky Mineral (S1)
___ 2.5 cm Mucky Peat or Peat (S2) **(LRR G)**
___ Sandy Gleyed Matrix (S4)
___ Sandy Redox (S5)
___ Stripped Matrix (S6)
___ Loamy Mucky Mineral (F1) **(except MLRA 1)**
___ Loamy Gleyed Matrix (F2)
___ Depleted Matrix (F3)
___ Redox Dark Surface (F6)
___ Depleted Dark Surface (F7)
___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

___ 2 cm Muck (A10) **(LRR A, E)**
___ Iron-Manganese Masses (F12) **(LRR D)**
___ Red Parent Material (F21)
___ Very Shallow Dark Surface (F22)
___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: none
Depth (inches): ___

Hydric Soil Present? **Yes** ___ **No** X

Remarks:
No redoximorphic features present.

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

___ Surface Water (A1)
___ High Water Table (A2)
___ Saturation (A3)
___ Water Marks (B1)
___ Sediment Deposits (B2)
___ Drift Deposits (B3)
___ Algal Mat or Crust (B4)
___ Iron Deposits (B5)
___ Surface Soil Cracks (B6)
___ Inundation Visible on Aerial Imagery (B7)
___ Sparsely Vegetated Concave Surface (B8)
___ Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A, and 4B**)
___ Salt Crust (B11)
___ Aquatic Invertebrates (B13)
___ Hydrogen Sulfide Odor (C1)
___ Oxidized Rhizospheres on Living Roots (C3)
___ Presence of Reduced Iron (C4)
___ Recent Iron Reduction in Tilled Soils (C6)
___ Stunted or Stressed Plants (D1) (**LRR A**)
___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

___ Water-Stained Leaves (B9) (**MLRA 1, 2 4A, and 4B**)
___ Drainage Patterns (B10)
___ Dry-Season Water Table (C2)
___ Saturation Visible on Aerial Imagery (C9)
___ Geomorphic Position (D2)
___ Shallow Aquitard (D3)
___ FAC-Neutral Test (D5)
___ Raised Ant Mounds (D6) (**LRR A**)
___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present? Yes ___ No X Depth (inches): ___
Water Table Present? Yes ___ No X Depth (inches): ___
Saturation Present? (includes capillary fringe) Yes ___ No X Depth (inches): ___

Wetland Hydrology Present? **Yes** ___ **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:
Soil lightly moist at around 10 inches deep but no saturation or other hydrology indicators present.

WETLAND DETERMINATION DATA FORM – Western Mountains, Valleys and Coast Region

Project/Site: Freeman Road Logistics City/County: Puyallup/Pierce County Sampling Date: 3/11/2022
Applicant/Owner: Vector Development Company State: WA Sampling Point: DP-13
Investigator(s): C. Douglas, M. Curran Section, Township, Range: S17 R4E T20N
Landform (hillslope, terrace, etc.): Forested Local relief (concave, convex, none): concave Slope: 1-5
Subregion (LRR): Northwest Forests and Coast (LRR A) Lat: 47.21406277 Long: -122.318663 Datum: NAD83
Soil Map Unit Name: Pilchuck fine sand NWI Classification: PFO, PSS, POW
Are climatic / hydrologic conditions on the site typical for this time of year? Yes x No (If no, explain in Remarks)
Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" Present? Yes x No
Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes **X**	No	
Hydric Soil Present?	Yes	No **X**	**Is the Sampled Area within a Wetland?** **Yes** **No X**
Wetland Hydrology Present?	Yes **X**	No	

Remarks: Depression area within grass pasture, ground is cleared of vegetation, grass vegetation surrounds standing water

VEGETATION

Tree Stratum (Plot size:)	Absolute % Cover	Dominant Species?	Indicator Status?
1.			
2.			
3.			
4.			
5.			
50%= 0 20%= 0 Total Cover: **0**			
Sapling/Shrub Stratum (Plot size:)			
1.			
2.			
3.			
4.			
5.			
50%= 0 20%= 0 Total Cover: **0**			
Herb Stratum (Plot size:)			
1. *Agrostis capillaris*	30	Yes	FAC
2. *Festuca rubra*	70	Yes	FAC
3.			
4.			
5.			
6.			
7.			
8.			
9.			
50%= 50 20%= 20 Total Cover: **100**			
Woody Vine Stratum (Plot size:)			
1.			
2.			
Total Cover: **0**			
% Bare Ground in Herb Stratum **0** % Cover of Biotic Crust			

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: **2** (A)
Total Number of Dominant Species Across All Strata: **2** (B)
Percent of Dominant Species That Are OBL, FACW, or FAC: **100%** (A/B)

Prevalence Index Worksheet:

Total % Cover of:		Multiply by:
OBL species	**0**	x1 = **0**
FACW species	**0**	x2 = **0**
FAC species	**100**	x3 = **300**
FACU species	**0**	x4 = **0**
UPL species	**0**	x5 = **0**
Column Totals:	**100** (A)	**300** (B)

Prevalence Index = B/A = **3.0**

Hydrophytic Vegetation Indicators:

- 1 - Rapid Test for Hydrophytic Vegetation
- **X** 2 - Dominance Test is >50%
- **X** 3 - Prevalence Index is ≤3.0[1]
- 4 - Morphological Adaptation[1] (Provide supporting data in Remarks or on a separate sheet)
- 5 - Wetland Non-Vascular Plants[1]
- Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? **Yes X** **No**

Remarks: 100% FAC vegetation, mowed grass pasture

SOIL

Sampling Point: DP-13

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-18	10YR 4/3	99	10YR 5/4	1	D	M	SiL	

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Muck Mineral (S1)
- ___ Sandy gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) (**except MLRA 1**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR B**)
- ___ Red Parent Material (TF2)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if present):

Type: ___

Depth (inches): ___

Hydric Soil Present? **Yes** ___ **No** X

Remarks: 3 chroma with redox

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum one required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- x Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres along Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Plowed Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- ___ Water-Stained Leaves (B9) (**MLRA 1, 2, 4A and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present? Yes ___ No x Depth (inches): ___

Water table Present? Yes ___ No x Depth (inches): ___

Saturation Present? (includes capillary fringe) Yes x No ___ Depth (inches): 14 inches

Wetland Hydrology Present? **Yes** X **No** ___

Describe Recorded Data (Unnamed Tributary gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks: Saturation at 14 inches

WETLAND DETERMINATION DATA FORM – Western Mountains, Valleys and Coast Region

Project/Site: Freeman Road Logistics City/County: Puyallup/Pierce County Sampling Date: 3/11/2022
Applicant/Owner: Vector Development Company State: WA Sampling Point: DP-14
Investigator(s): C. Douglas, M. Curran Section, Township, Range: S17 R4E T20N
Landform (hillslope, terrace, etc.): Forested Local relief (concave, convex, none): concave Slope: 1-5
Subregion (LRR): Northwest Forests and Coast (LRR A) Lat: 47.21400951 Long: -122.3185192 Datum: NAD83
Soil Map Unit Name: Pilchuck fine sand NWI Classification: PFO, PSS, POW
Are climatic / hydrologic conditions on the site typical for this time of year? Yes x No _____ (If no, explain in Remarks)
Are Vegetation x , Soil x , or Hydrology _____ significantly disturbed? Are "Normal Circumstances" Present? Yes x No _____
Are Vegetation _____ , Soil _____ , or Hydrology _____ naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes **X**	No _____	**Is the Sampled Area within a Wetland?** **Yes X** **No** _____
Hydric Soil Present?	Yes **X**	No _____	
Wetland Hydrology Present?	Yes **X**	No _____	

Remarks: Depression area within grass pasture, ground is cleared of vegetation, grass vegetation surrounds standing water.

VEGETATION

Tree Stratum (Plot size: _____)	Absolute % Cover	Dominant Species?	Indicator Status?
1.			
2.			
3.			
4.			
5.			
50%= 0 20%= 0 Total Cover: **0**			
Sapling/Shrub Stratum (Plot size: _____)			
1.			
2.			
3.			
4.			
5.			
50%= 0 20%= 0 Total Cover: **0**			
Herb Stratum (Plot size: _____)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
50%= 0 20%= 0 Total Cover: **0**			
Woody Vine Stratum (Plot size: _____)			
1.			
2.			
Total Cover: **0**			
% Bare Ground in Herb Stratum **100** % Cover of Biotic Crust _____			

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: **0** (A)

Total Number of Dominant Species Across All Strata: **0** (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: **0%** (A/B)

Prevalence Index Worksheet:

Total % Cover of:		Multiply by:	
OBL species	**0**	x1 =	**0**
FACW species	**0**	x2 =	**0**
FAC species	**0**	x3 =	**0**
FACU species	**0**	x4 =	**0**
UPL species	**0**	x5 =	**0**
Column Totals:	**0** (A)		**0** (B)

Prevalence Index = B/A = **0.0**

Hydrophytic Vegetation Indicators:

_____ 1 - Rapid Test for Hydrophytic Vegetation
_____ 2 - Dominance Test is >50%
_____ 3 - Prevalence Index is ≤3.0[1]
_____ 4 - Morphological Adaptation[1] (Provide supporting data in Remarks or on a separate sheet)
_____ 5 - Wetland Non-Vascular Plants[1]
_____ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Hydrophytic Vegetation Present? **Yes X** **No** _____

Remarks: No vegetation in standing water depression within grass pasture

SOIL

Sampling Point: DP-14

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 5/2	90	10YR 5/4	10	D	M	SiL	
8-18	10YR 5/1	70	7.5YR 4/4	30	D	M	SiL	

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators: (Applicable to all LRRs, unless otherwise noted.)

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Muck Mineral (S1)
- ___ Sandy gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Loamy Mucky Mineral (F1) (**except MLRA 1**)
- ___ Loamy Gleyed Matrix (F2)
- X Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR B**)
- ___ Red Parent Material (TF2)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if present):

Type: ___

Depth (inches): ___

Hydric Soil Present? **Yes** X **No** ___

Remarks: 1 and 2 chroma with redox

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum one required; check all that apply)

- x Surface Water (A1)
- ___ High Water Table (A2)
- x Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Surface Soil Cracks (B6)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9) (**except MLRA 1, 2, 4A and 4B**)
- ___ Salt Crust (B11)
- ___ Aquatic Invertebrates (B13)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres along Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Plowed Soils (C6)
- ___ Stunted or Stressed Plants (D1) (**LRR A**)
- ___ Other (Explain in Remarks)

Secondary Indicators (2 or more required)

- ___ Water-Stained Leaves (B9) (**MLRA 1, 2, 4A and 4B**)
- ___ Drainage Patterns (B10)
- ___ Dry-Season Water Table (C2)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ FAC-Neutral Test (D5)
- ___ Raised Ant Mounds (D6) (**LRR A**)
- ___ Frost-Heave Hummocks (D7)

Field Observations:

Surface Water Present? Yes x No ___ Depth (inches): 3 inches

Water table Present? Yes ___ No x Depth (inches): ___

Saturation Present? (includes capillary fringe) Yes x No ___ Depth (inches): at surface

Wetland Hydrology Present? **Yes** X **No** ___

Describe Recorded Data (Unnamed Tributary gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks: Standing water a few inches deep in depression. No water table, surface water flowed into data plot hole.

Appendix C-2
Wetland A Rating

Wetland name or number A

RATING SUMMARY – Western Washington

Name of wetland (or ID #): Offsite Wetland A Date of site visit: 3/11/22 and 5/30/23

Rated by C. Douglas, H. Fotherby, J. Rowny Trained by Ecology? X Yes ___No Date of training '07, '22, '16

HGM Class used for rating Depressional Wetland has multiple HGM classes? ___Y X N

NOTE: **Form is not complete without the required figures** (figures can be combined).
Source of base aerial photo/map ESRI

OVERALL WETLAND CATEGORY II (based on functions X or special characteristics__)

1. Category of wetland based on FUNCTIONS

_____**Category I** – Total score = 23 - 27
X **Category II** – Total score = 20 - 22
_____**Category III** – Total score = 16 - 19
_____**Category IV** – Total score = 9 - 15

FUNCTION	Improving Water Quality			Hydrologic			Habitat			
	Circle the appropriate ratings									
Site Potential	H	**M**	L	**H**	M	L	H	**M**	L	
Landscape Potential	H	**M**	L	**H**	M	L	H	M	**L**	
Value	**H**	M	L	**H**	M	L	**H**	M	L	**TOTAL**
Score Based on Ratings	7			9			6			22

Score for each function based on three ratings (order of ratings is not important)

9 = H, H, H
8 = H, H, M
7 = H, H, L
7 = H, M, M
6 = H, M, L
6 = M, M, M
5 = H, L, L
5 = M, M, L
4 = M, L, L
3 = L, L, L

2. Category based on SPECIAL CHARACTERISTICS of wetland

CHARACTERISTIC	CATEGORY
Estuarine	**I II**
Wetland of High Conservation Value	**I**
Bog	**I**
Mature Forest	**I**
Old Growth Forest	**I**
Coastal Lagoon	**I II**
Interdunal	**I II III IV**
None of the above	X

Wetland name or number A

Maps and figures required to answer questions correctly for Western Washington

Depressional Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	D 1.3, H 1.1, H 1.4	
Hydroperiods	D 1.4, H 1.2	
Location of outlet (*can be added to map of hydroperiods)*	D 1.1, D 4.1	
Boundary of area within 150 ft of the wetland *(can be added to another figure)*	D 2.2, D 5.2	
Map of the contributing basin	D 4.3, D 5.3	
1 km Polygon: Area that extends 1 km from entire wetland edge - including polygons for accessible habitat and total habitat	H 2.1, H 2.2, H 2.3	
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	D 3.1, D 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	D 3.3	

Riverine Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	H 1.1, H 1.4	
Hydroperiods	H 1.2	
Ponded depressions	R 1.1	
Boundary of area within 150 ft of the wetland *(can be added to another figure)*	R 2.4	
Plant cover of trees, shrubs, and herbaceous plants	R 1.2, R 4.2	
Width of unit vs. width of stream *(can be added to another figure)*	R 4.1	
Map of the contributing basin	R 2.2, R 2.3, R 5.2	
1 km Polygon: Area that extends 1 km from entire wetland edge - including polygons for accessible habitat and total habitat	H 2.1, H 2.2, H 2.3	
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	R 3.1	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	R 3.2, R 3.3	

Lake Fringe Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	L 1.1, L 4.1, H 1.1, H 1.4	
Plant cover of trees, shrubs, and herbaceous plants	L 1.2	
Boundary of area within 150 ft of the wetland *(can be added to another figure)*	L 2.2	
1 km Polygon: Area that extends 1 km from entire wetland edge - including polygons for accessible habitat and total habitat	H 2.1, H 2.2, H 2.3	
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	L 3.1, L 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	L 3.3	

Slope Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	H 1.1, H 1.4	
Hydroperiods	H 1.2	
Plant cover of **dense** trees, shrubs, and herbaceous plants	S 1.3	
Plant cover of **dense, rigid** trees, shrubs, and herbaceous plants (*can be added to figure above)*	S 4.1	
Boundary of 150 ft buffer (can be added to another figure)	S 2.1, S 5.1	
1 km Polygon: Area that extends 1 km from entire wetland edge - including polygons for accessible habitat and total habitat	H 2.1, H 2.2, H 2.3	
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	S 3.1, S 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	S 3.3	

Wetland name or number A

HGM Classification of Wetlands in Western Washington

For questions 1-7, the criteria described must apply to the entire unit being rated.

If the hydrologic criteria listed in each question do not apply to the entire unit being rated, you probably have a unit with multiple HGM classes. In this case, identify which hydrologic criteria in questions 1-7 apply, and go to Question 8.

1. Are the water levels in the entire unit usually controlled by tides except during floods?

   NO – go to 2 **YES** – the wetland class is **Tidal Fringe** – go to 1.1

   1.1 Is the salinity of the water during periods of annual low flow below 0.5 ppt (parts per thousand)?

   NO – Saltwater Tidal Fringe (Estuarine) **YES – Freshwater Tidal Fringe**
   If your wetland can be classified as a Freshwater Tidal Fringe use the forms for **Riverine** wetlands. If it is Saltwater Tidal Fringe, it is an **Estuarine** wetland and is not scored. This method **cannot** be used to score functions for estuarine wetlands.

2. The entire wetland unit is flat, and precipitation is the only source (>90%) of water to it. Groundwater and surface water runoff are NOT sources of water to the unit.

   NO – go to 3 **YES** – The wetland class is **Flats**
   If your wetland can be classified as a Flats wetland, use the form for **Depressional** wetlands.

3. Does the entire wetland unit **meet all** of the following criteria?
   ___The vegetated part of the wetland is on the shores of a body of permanent open water (without any plants on the surface at any time of the year) at least 20 ac (8 ha) in size,
   ___At least 30% of the open water area is deeper than 6.6 ft (2 m).

   NO – go to 4 **YES –** The wetland class is **Lake Fringe** (Lacustrine Fringe)

4. Does the entire wetland unit **meet all** of the following criteria?
   ____The wetland is on a slope (slope can be very gradual),
   ____The water flows through the wetland in one direction (unidirectional) and usually comes from seeps. It may flow subsurface, as sheet flow, or in a swale without distinct banks,
   ____The water leaves the wetland **without being impounded**.

   NO – go to 5 **YES –** The wetland class is **Slope**

   NOTE: Surface water does not pond in these type of wetlands except occasionally in very small and shallow depressions or behind hummocks (depressions are usually <3 ft diameter and less than 1 ft deep).

Wetland name or number A

5. Does the entire wetland unit **meet all** of the following criteria?
   ____The unit is in a valley, or stream channel, where it gets inundated by overbank flooding from that stream or river,
   ____The overbank flooding occurs at least once every 2 years.

   NO – go to 6 **YES** – The wetland class is **Riverine**
   NOTE: The Riverine unit can contain depressions that are filled with water when the river is not flooding

6. Is the entire wetland unit in a topographic depression in which water ponds, or is saturated to the surface, at some time during the year? This means that any outlet, if present, is higher than the interior of the wetland.

   NO – go to 7 **YES** – The wetland class is **Depressional**

7. Is the entire wetland unit located in a very flat area with no obvious depression and no overbank flooding? The unit does not pond surface water more than a few inches. The unit seems to be maintained by high groundwater in the area. The wetland may be ditched but has no obvious natural outlet.

   NO – go to 8 **YES** – The wetland class is **Depressional**

8. Your wetland unit seems to be difficult to classify and probably contains several different HGM classes. For example, seeps at the base of a slope may grade into a riverine floodplain, or a small stream within a Depressional wetland has a zone of flooding along its sides. GO BACK AND IDENTIFY WHICH OF THE HYDROLOGIC REGIMES DESCRIBED IN QUESTIONS 1-7 APPLY TO DIFFERENT AREAS IN THE UNIT (make a rough sketch to help you decide). Use the following table to identify the appropriate class to use for the rating system if you have several HGM classes present within the wetland unit being scored.

   NOTE: Use this table only if the class that is recommended in the second column represents 10% or more of the total area of the wetland unit being rated. If the area of the HGM class listed in column 2 is less than 10% of the unit; classify the wetland using the class that represents more than 90% of the total area.

HGM classes within the wetland unit being rated	HGM class to use in rating
Slope + Riverine	Riverine
Slope + Depressional	Depressional
Slope + Lake Fringe	Lake Fringe
Depressional + Riverine along stream within boundary of depression	Depressional
Depressional + Lake Fringe	Depressional
Riverine + Lake Fringe	Riverine
Salt Water Tidal Fringe and any other class of freshwater wetland	Treat as ESTUARINE

If you are still unable to determine which of the above criteria apply to your wetland, or if you have **more than 2 HGM classes** within a wetland boundary, classify the wetland as Depressional for the rating.

Wetland name or number A

DEPRESSIONAL AND FLATS WETLANDS

Water Quality Functions - Indicators that the site functions to improve water quality

D 1.0. Does the site have the potential to improve water quality?	
D 1.1. Characteristics of surface water outflows from the wetland: Wetland is a depression or flat depression (QUESTION 7 on key) with no surface water leaving it (no outlet). points = 3 Wetland has an intermittently flowing stream or ditch, OR highly constricted permanently flowing outlet. points = 2 Wetland has an unconstricted, or slightly constricted, surface outlet that is permanently flowing points = 1 Wetland is a flat depression (QUESTION 7 on key), whose outlet is a permanently flowing ditch. points = 1	3
D 1.2. The soil 2 in. below the surface (or duff layer) is true clay or true organic *(use NRCS definitions).* Yes = 4 No = 0	0
D 1.3. Characteristics and distribution of persistent plants (Emergent, Scrub-shrub, and/or Forested Cowardin classes): Wetland has persistent, ungrazed plants > 95% of area points = 5 Wetland has persistent, ungrazed plants > ½ of area points = 3 Wetland has persistent, ungrazed plants ≥ 1/10 of area points = 1 Wetland has persistent, ungrazed plants < 1/10 of area points = 0	3
D 1.4. Characteristics of seasonal ponding or inundation: *This is the area that is ponded for at least 2 months. See description in manual.* Area seasonally ponded is > ½ total area of wetland points = 4 Area seasonally ponded is ≥ ¼ total area of wetland points = 2 Area seasonally ponded is < ¼ total area of wetland points = 0	2
Total for D 1 — Add the points in the boxes above	8

Rating of Site Potential If score is: __**12-16 = H** X **6-11 = M** ___**0-5 = L** *Record the rating on the first page*

D 2.0. Does the landscape have the potential to support the water quality function of the site?	
D 2.1. Does the wetland unit receive stormwater discharges? Yes = 1 No = 0	1
D 2.2. Is > 10% of the area within 150 ft of the wetland in land uses that generate pollutants? Yes = 1 No = 0	1
D 2.3. Are there septic systems within 250 ft of the wetland? Yes = 1 No = 0	0
D 2.4. Are there other sources of pollutants coming into the wetland that are not listed in questions D 2.1-D 2.3? Source_____ Yes = 1 No = 0	0
Total for D 2 — Add the points in the boxes above	2

Rating of Landscape Potential If score is: __**3 or 4 = H** X **1 or 2 = M** ___**0 = L** *Record the rating on the first page*

D 3.0. Is the water quality improvement provided by the site valuable to society?	
D 3.1. Does the wetland discharge directly (i.e., within 1 mi) to a stream, river, lake, or marine water that is on the 303(d) list? Yes = 1 No = 0	0
D 3.2. Is the wetland in a basin or sub-basin where an aquatic resource is on the 303(d) list? Yes = 1 No = 0	1
D 3.3. Has the site been identified in a watershed or local plan as important for maintaining water quality? (Answer YES if there is a TMDL in development or in effect for the basin in which the unit is found.) Yes = 2 No = 0	2
Total for D 3 — Add the points in the boxes above	3

Rating of Value If score is: X **2-4 = H** ___**1 = M** ___**0 = L** *Record the rating on the first page*

Wetland name or number A

DEPRESSIONAL AND FLATS WETLANDS

Hydrologic Functions - Indicators that the site functions to reduce flooding and stream degradation

D 4.0. Does the site have the potential to reduce flooding and erosion?

D 4.1. Characteristics of surface water outflows from the wetland: **4**

- Wetland is a depression or flat depression with no surface water leaving it (no outlet) — points = 4
- Wetland has an intermittently flowing stream/ditch, OR highly constricted permanently flowing outlet — points = 2
- Wetland is a flat depression (question 7 on key), whose outlet is a permanently flowing ditch — points = 1
- Wetland has an unconstricted, or slightly constricted, surface outlet that is permanently flowing — points = 0

D 4.2. Depth of storage during wet periods: Estimate the height of ponding above the bottom of the outlet. For wetlands with no outlet, measure from the surface of permanent water or if dry, the deepest part. **7**

- Marks of ponding are 3 ft or more above the surface or bottom of outlet — points = 7
- Marks of ponding between 2 ft to < 3 ft from surface or bottom of outlet — points = 5
- Marks are at least 0.5 ft to < 2 ft from surface or bottom of outlet — points = 3
- The wetland is a "headwater" wetland — points = 3
- Wetland is flat but has small depressions on the surface that trap water — points = 1
- Marks of ponding less than 0.5 ft (6 in) — points = 0

D 4.3. Contribution of the wetland to storage in the watershed: Estimate the ratio of the area of upstream basin contributing surface water to the area of the wetland unit itself. **5**

- The area of the basin is less than 10 times the area of the unit — points = 5
- The area of the basin is 10 to 100 times the area of the unit — points = 3
- The area of the basin is more than 100 times the area of the unit — points = 0
- Entire wetland is in the Flats class — points = 5

Total for D 4	Add the points in the boxes above	16

Rating of Site Potential If score is: X **12-16 = H** ___**6-11 = M** ___**0-5 = L** *Record the rating on the first page*

D 5.0. Does the landscape have the potential to support hydrologic functions of the site?

D 5.1. Does the wetland receive stormwater discharges?	Yes = 1 No = 0	1
D 5.2. Is >10% of the area within 150 ft of the wetland in land uses that generate excess runoff?	Yes = 1 No = 0	1
D 5.3. Is more than 25% of the contributing basin of the wetland covered with intensive human land uses (residential at >1 residence/ac, urban, commercial, agriculture, etc.)?	Yes = 1 No = 0	1
Total for D 5	Add the points in the boxes above	3

Rating of Landscape Potential If score is: X **3 = H** ___**1 or 2 = M** ___**0 = L** *Record the rating on the first page*

D 6.0. Are the hydrologic functions provided by the site valuable to society?

D 6.1. Is the unit in a landscape that has flooding problems? Choose the description that best matches conditions around the wetland unit being rated. Do not add points. Choose the highest score if more than one condition is met. **2**

The wetland captures surface water that would otherwise flow downgradient into areas where flooding has damaged human or natural resources (e.g., houses or salmon redds):

- Flooding occurs in a sub-basin that is immediately downgradient of unit. — points = 2
- Surface flooding problems are in a sub-basin farther downgradient. — points = 1
- Flooding from groundwater is an issue in the sub-basin. — points = 1
- The existing or potential outflow from the wetland is so constrained by human or natural conditions that the water stored by the wetland cannot reach areas that flood. *Explain why* _____ — points = 0
- There are no problems with flooding downstream of the wetland. — points = 0

D 6.2. Has the site been identified as important for flood storage or flood conveyance in a regional flood control plan? Yes = 2 No = 0 **2**

Total for D 6	Add the points in the boxes above	4

Rating of Value If score is: X **2-4 = H** ___**1 = M** ___**0 = L** *Record the rating on the first page*

Wetland name or number A

These questions apply to wetlands of all HGM classes.

HABITAT FUNCTIONS - Indicators that site functions to provide important habitat

H 1.0. Does the site have the potential to provide habitat?

H 1.1. Structure of plant community: Indicators are Cowardin classes and strata within the Forested class. Check the Cowardin plant classes in the wetland. Up to 10 patches may be combined for each class to meet the threshold of ¼ ac if the unit is at least 2.5 ac, or more than 10% of the unit if it is smaller than 2.5 ac. **2**

____Aquatic bed	4 structures or more: points = 4
X Emergent	3 structures: points = 2
X Scrub-shrub (areas where shrubs have > 30% cover)	2 structures: points = 1
X Forested (areas where trees have > 30% cover)	1 structure: points = 0

If the unit has a Forested class, check if:

____The Forested class has 3 out of 5 strata (canopy, sub-canopy, shrubs, herbaceous, moss/groundcover) that each cover 20% within the Forested polygon

H 1.2. Hydroperiods **2**

Check the types of water regimes (hydroperiods) present within the wetland. The water regime has to cover more than 10% of the wetland if the unit is < 2.5 ac, or ¼ ac if the unit is at least 2.5 ac to count (see text for descriptions of hydroperiods).

X Permanently flooded or inundated	4 or more types present: points = 3
X Seasonally flooded or inundated	3 types present: points = 2
____Occasionally flooded or inundated	2 types present: points = 1
X Saturated only	1 type present: points = 0
____Permanently flowing stream or river in, or adjacent to, the wetland	
____Intermittently or seasonally flowing stream in, or adjacent to, the wetland	
____**Lake Fringe wetland**	**2 points**
____**Freshwater tidal wetland**	**2 points**

H 1.3. Richness of plant species **1**

Count the number of plant species in the wetland that cover at least 10 ft^2.

Different patches of the same species can be combined to meet the size threshold and you do not have to name the species. **Do not include Eurasian milfoil, reed canarygrass, purple loosestrife, Canada thistle**


If you counted: > 19 species	points = 2
5 - 19 species	points = 1
< 5 species	points = 0

H 1.4. Interspersion of habitats **2**

Decide from the diagrams below whether interspersion among Cowardin plants classes (described in H 1.1), or the classes and unvegetated areas (can include open water or mudflats) is high, moderate, low, or none. If you have four or more plant classes or three classes and open water, the rating is always high.



None = 0 points




Low = 1 point



Moderate = 2 points

All three diagrams in this row are **High** = 3 points

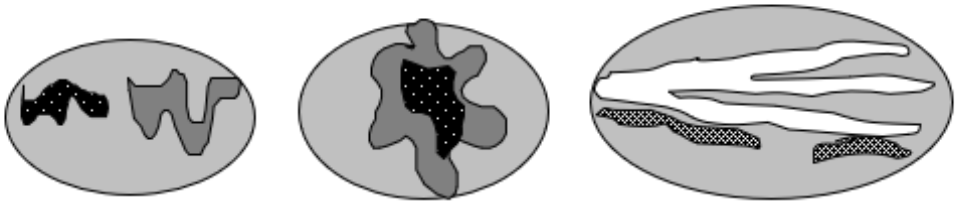

Wetland name or number A

H 1.5. Special habitat features: Check the habitat features that are present in the wetland. The number of checks is the number of points. X Large, downed, woody debris within the wetland (> 4 in. diameter and 6 ft long). X Standing snags (dbh > 4 in.) within the wetland ____Undercut banks are present for at least 6.6 ft (2 m) **and/or** overhanging plants extend at least 3.3 ft (1 m) over open water or a stream (or ditch) in, or contiguous with the wetland, for at least 33 ft (10 m) X Stable steep banks of fine material that might be used by beaver or muskrat for denning (> 30 degree slope) OR signs of recent beaver activity are present (cut shrubs or trees that have not yet weathered where wood is exposed) X At least ¼ ac of thin-stemmed persistent plants or woody branches are present in areas that are permanently or seasonally inundated (structures for egg-laying by amphibians) ____Invasive plants cover less than 25% of the wetland area in every stratum of plants (see H 1.1 above for the list of strata and H 1.5 in the manual for the list of aggressive plant species)	4
Total for H 1 Add the points in the boxes above	11

Rating of Site Potential If score is: __**15-18 = H** X **7-14 = M** ___**0-6 = L** *Record the rating on the first page*

H 2.0. Does the landscape have the potential to support the habitat functions of the site?	
H 2.1. Accessible habitat (include only habitat polygons accessible from the wetland. *Calculate:* % relatively undisturbed habitat 5 **+** [(% moderate and low intensity land uses)/2] 0 = 5 % Total accessible habitat is: > 1/3 (33.3%) of 1 km Polygon points = 3 20-33% of 1 km Polygon points = 2 10-19% of 1 km Polygon points = 1 < 10% of 1 km Polygon points = 0	0
H 2.2. Total habitat in 1 km Polygon around the wetland. *Calculate:* % relatively undisturbed habitat 10 **+** [(% moderate and low intensity land uses)/2] 10 = 20 % Total habitat > 50% of Polygon points = 3 Total habitat 10-50% and in 1-3 patches points = 2 Total habitat 10-50% and > 3 patches points = 1 Total habitat < 10% of 1 km Polygon points = 0	1
H 2.3. Land use intensity in 1 km Polygon: > 50% of 1 km Polygon is high intensity land use points = (- 2) ≤ 50% of 1 km Polygon is high intensity points = 0	-2
Total for H 2 Add the points in the boxes above	-1

Rating of Landscape Potential If score is: __**4-6 = H** ___**1-3 = M** X **< 1 = L** *Record the rating on the first page*

H 3.0. Is the habitat provided by the site valuable to society?	
H 3.1. Does the site provide habitat for species valued in laws, regulations, or policies? *Choose only the highest score that applies to the wetland being rated.* Site meets ANY of the following criteria: points = 2 — It has 3 or more Priority Habitats within 100 m (see next page) — It provides habitat for Threatened or Endangered species (any plant or animal on the state or federal lists) — It is mapped as a location for an individual WDFW Priority Species — It is a Wetland of High Conservation Value as determined by the Department of Natural Resources data — It has been categorized as an important habitat site in a local or regional comprehensive plan, in a Shoreline Master Plan, or in a watershed plan Site has 1 or 2 Priority Habitats (listed on next page) within 100 m points = 1 Site does not meet any of the criteria above points = 0	2

Rating of Value If score is: __**2 = H** ___**1 = M** ___**0 = L** *Record the rating on the first page*

Wetland name or number A

WDFW Priority Habitats

See complete descriptions of Priority Habitats listed by WDFW, and the counties in which they can be found, in: Washington Department of Fish and Wildlife. 2008 (current year, as revised). Priority Habitat and Species List.[133] This list was updated for consistency with guidance from WDFW.

This question is independent of the land use between the wetland unit and the Priority Habitat. All vegetated wetlands are by definition a Priority Habitat but are not included in this list because they are addressed by this rating system.

Count how many of the following Priority Habitats are within 330 ft (100 m) of the wetland unit:

— **Aspen Stands:** Pure or mixed stands of aspen greater than 1 ac (0.4 ha).

— **Biodiversity Areas and Corridors**: Areas of habitat that are relatively important to various species of native fish and wildlife. This habitat automatically counts if mapped on the PHS online map within 100m of the wetland. If not mapped, a determination can be made in the field.

— **Caves:** A naturally occurring cavity, recess, void, or system of interconnected passages under the earth in soils, rock, ice, or other geological formations and is large enough to contain a human.

— **Cliffs:** Greater than 25 ft (7.6 m) high and occurring below 5000 ft elevation.

— **Fresh Deepwater:** Lands permanently flooded with freshwater, including environments where surface water is permanent and often deep, so that water, rather than air, is the principal medium within which the dominant organisms live. Substrate does not support emergent vegetation. Do not select if Instream habitat is also present, or if the entire Deepwater feature is included in the wetland unit being rated (such as a pond with a vegetated fringe).

— **Herbaceous Balds:** Variable size patches of grass and forbs on shallow soils over bedrock.

X **Instream:** The combination of physical, biological, and chemical processes and conditions that interact to provide functional life history requirements for instream fish and wildlife resources. Do not select if Fresh Deepwater habitat is also present.

— **Nearshore:** Relatively undisturbed nearshore habitats. These include Coastal Nearshore, Open Coast Nearshore, and Puget Sound Nearshore.

— **Old-growth/Mature forests:** Old-growth west of Cascade crest – Stands of at least 2 tree species, forming a multi-layered canopy with occasional small openings; with at least 8 trees/ac (20 trees/ha) > 32 in. (81 cm) diameter at breast height (dbh) or > 200 years of age. Mature forests – Stands with average diameters exceeding 21 in. (53 cm) dbh; crown cover may be less than 100%; decay, decadence, numbers of snags, and quantity of large downed material is generally less than that found in old-growth; 80-200 years old west of the Cascade crest.

[133] http://wdfw.wa.gov/publications/00165/wdfw00165.pdf

Wetland name or number A

— **Oregon White Oak:** Woodland stands of pure oak or oak/conifer associations where canopy coverage of the oak component is important. For single oaks or oak stands <0.4 ha in urban areas, WDFW's Management Recommendations for Oregon White Oak[134] provides more detail for determining if they are Priority Habitats

X **Riparian:** The area adjacent to freshwater aquatic systems with flowing or standing water that contains elements of both aquatic and terrestrial ecosystems which mutually influence each other.

X **Snags and Logs:** Trees are considered snags if they are dead or dying and exhibit sufficient decay characteristics to enable cavity excavation/use by wildlife. Priority snags have a diameter at breast height of > 20 in. (51 cm) in western Washington and are > 6.5 ft (2 m) in height. Priority logs are > 12 in. (30 cm) in diameter at the largest end, and > 20 ft (6 m) long.

— **Talus:** Homogenous areas of rock rubble ranging in average size 0.5 - 6.5 ft (0.15 - 2.0 m), composed of basalt, andesite, and/or sedimentary rock, including riprap slides and mine tailings. May be associated with cliffs.

— **Westside Prairies:** Herbaceous, non-forested plant communities that can either take the form of a dry prairie or a wet prairie.

[134] https://wdfw.wa.gov/publications/00030/wdfw00030.pdf

Wetland name or number A

CATEGORIZATION BASED ON SPECIAL CHARACTERISTICS

Wetland Type *Check off any criteria that apply to the wetland. Circle the category when the appropriate criteria are met.*	**Category**
SC 1.0. Estuarine wetlands Does the wetland meet the following criteria for Estuarine wetlands? — The dominant water regime is tidal, — Vegetated, and — With a salinity greater than 0.5 ppt Yes – Go to **SC 1.1** No= **Not an estuarine wetland**	
SC 1.1. Is the wetland within a National Wildlife Refuge, National Park, National Estuary Reserve, Natural Area Preserve, State Park or Educational, Environmental, or Scientific Reserve designated under WAC 332-30-151? Yes = **Category I** No – Go to **SC 1.2**	**Cat. I**
SC 1.2. Is the wetland unit at least 1 ac in size and meets at least two of the following three conditions? — The wetland is relatively undisturbed (has no diking, ditching, filling, cultivation, grazing), and has less than 10% cover of non-native plant species. If non-native species are *Spartina*, see chapter 4.8 in the manual. — At least ¾ of the landward edge of the wetland has a 100 ft buffer of shrub, forest, or un-grazed or un-mowed grassland. — The wetland has at least two of the following features: tidal channels, depressions with open water, or contiguous freshwater wetlands. Yes = **Category I** No = **Category II**	**Cat. I** **Cat. II**
SC 2.0. Wetlands of High Conservation Value (WHCV) SC 2.1. Does the wetland overlap with any known or historical rare plant or rare & high-quality ecosystem polygons on the WNHP Data Explorer?[135] Yes = **Category I** No – Go to **SC 2.2** SC 2.2. Does the wetland have a rare plant species, rare ecosystem (e.g., plant community), or high-quality common ecosystem that may qualify the site as a WHCV? Contact WNHP for resources to help determine the presence of these elements. Yes – Submit data to WA Natural Heritage Program for determination,[136] Go to **SC 2.3** No = **Not a WHCV** SC 2.3. Did WNHP review the site within 30 days and determine that it has a rare plant or ecosystem that meets their criteria? Yes = **Category I** No = **Not a WHCV**	**Cat. I**
SC 3.0. Bogs Does the wetland (or any part of the unit) meet both the criteria for soils and vegetation in bogs? *Use the key below.* ***If you answer YES, you will still need to rate the wetland based on its functions.*** SC 3.1. Does an area within the wetland unit have organic soil horizons, either peats or mucks, that compose 16 in. or more of the first 32 in. of the soil profile? Yes – Go to **SC 3.3** No – Go to **SC 3.2** SC 3.2. Does an area within the wetland unit have organic soils, either peats or mucks, that are less than 16 in. deep over bedrock, or an impermeable hardpan such as clay or volcanic ash, or that are floating on top of a lake or pond? Yes – Go to **SC 3.3** No = **Not a bog** SC 3.3. Does an area with peats or mucks have more than 70% cover of mosses at ground level, AND at least a 30% cover of plant species listed in Table 4? Yes = **Category I bog** No – Go to **SC 3.4** **NOTE:** If you are uncertain about the extent of mosses in the understory, you may substitute that criterion by measuring the pH of the water that seeps into a hole dug at least 16 in. deep. If the pH is less than 5.0 and the plant species in Table 4 are present, the wetland is a bog. SC 3.4. Is an area with peats or mucks forested (> 30% cover) with Sitka spruce, subalpine fir, western red cedar, western hemlock, lodgepole pine, quaking aspen, Engelmann spruce, or western white pine, AND any of the species (or combination of species) listed in Table 4 provide more than 30% of the cover under the canopy? Yes = **Category I bog** No = **Not a bog**	**Cat. I**

[135] https://www.dnr.wa.gov/NHPdata
[136] https://www.dnr.wa.gov/Publications/amp_nh_sighting_form.pdf

Wetland name or number A

SC 4.0. Forested Wetlands Does the wetland have at least 1 contiguous acre of forest that meets one of these criteria for the WA Department of Fish and Wildlife's forests as Priority Habitats? ***If you answer YES, you will still need to rate the wetland based on its functions.*** — **Old-growth forests** (west of Cascade crest): Stands of at least two tree species, forming a multi-layered canopy with occasional small openings; with at least 8 trees/ac (20 trees/ha) that are at least 200 years of age OR have a diameter at breast height (dbh) of 32 in. (81 cm) or more. — **Mature forests** (west of the Cascade Crest): Stands where the largest trees are 80- 200 years old OR the species that make up the canopy have an average diameter (dbh) exceeding 21 in. (53 cm). Yes = **Category I** No = **Not a forested wetland for this section**	**Cat. I**
SC 5.0. Wetlands in Coastal Lagoons Does the wetland meet all of the following criteria of a wetland in a coastal lagoon? — The wetland lies in a depression adjacent to marine waters that is wholly or partially separated from marine waters by sandbanks, gravel banks, shingle, or, less frequently, rocks — The lagoon in which the wetland is located contains ponded water that is saline or brackish (> 0.5 ppt) during most of the year in at least a portion of the lagoon *(needs to be measured near the bottom)* — The lagoon retains some of its surface water at low tide during spring tides Yes – Go to **SC 5.1** No = **Not a wetland in a coastal lagoon** SC 5.1. Does the wetland meet all of the following three conditions? — The wetland is relatively undisturbed (has no diking, ditching, filling, cultivation, grazing), and has less than 20% cover of aggressive, opportunistic plant species (see list of species in H 1.5 in the manual). — At least ¾ of the landward edge of the wetland has a 100 ft buffer of shrub, forest, or un-grazed or un-mowed grassland. — The wetland is larger than $^{1}/_{10}$ ac (4350 ft^2) Yes = **Category I** No = **Category II**	**Cat. I** **Cat. II**
SC 6.0. Interdunal Wetlands Is the wetland west of the 1889 line (also called the Western Boundary of Upland Ownership or WBUO)? ***If you answer YES, you will still need to rate the wetland based on its habitat functions.*** In practical terms that means the following geographic areas: — Long Beach Peninsula: Lands west of SR 103 — Grayland-Westport: Lands west of SR 105 — Ocean Shores-Copalis: Lands west of SR 115 and SR 109 and Ocean Shores Blvd SW, including lands west of E. Oceans Shores Blvd SW. Yes – Go to **SC 6.1** No = **Not an interdunal wetland for rating** SC 6.1. Is the wetland 1 ac or larger and scores an 8 or 9 for the habitat functions on the form (rates H,H,H or H,H,M for the three aspects of function)? Yes = **Category I** No – Go to **SC 6.2** SC 6.2. Is the wetland 1 ac or larger, or is it in a mosaic of wetlands that is 1 ac or larger? Yes = **Category II** No – Go to **SC 6.3** SC 6.3. Is the unit between 0.1 and 1 ac, or is it in a mosaic of wetlands that is between 0.1 and 1 ac? Yes = **Category III** No = **Category IV**	**Cat I** **Cat. II** **Cat. III** **Cat. IV**
Category of wetland based on Special Characteristics If you answered No for all types, enter "Not Applicable" on Summary Form	NA

Appendix C-3
Wetland A Figures



LEGEND:

NWI Wetland

- Freshwater Forested/ Shrub Wetland
- Freshwater Pond
- Riverine

City of Puyallup Wetlands Inventory

- Unverified

- 150 Foot Buffer of Wetland A
- Pollutant Generating Area
- Wetland Test Plot Location

0 350
Feet

Sources:
1. Aerial imagery: Esri (2022)
2. NWI: USFWS (2023)

Notes:
1. USDA: United States Department of Agriculture
2. NWI: National Wetland Inventory
3. USFWS: United States Fish and Wildlife Service
4. May 2023 field observations indicate upland conditions at DP-13 and unverified wetland area.

Publish Date: 2024/05/23, 2:02 PM | User: tweldy
Filepath: \\GSTFile01\GIS\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 1
Wetland A - Cowardin Vegetation Classes and 150-foot Wetland Offset
Wetland Rating Form - Wetland A
Freeman Road Logistics



LEGEND:

Hydroperiod

- Permanently Flooded
- Saturated

NOTE:
1. Aerial image provided by Esri Online Services.

0 350
Feet

Publish Date: 2023/07/06, 2:18 PM | User: jlarson
Filepath: \\orcas\GIS\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 2
Wetland A - Hydroperiods
Wetland Rating Form - Wetland A
Freeman Road Logistics



LEGEND:

- Wetland A
- Contributing Basin


NOTE:
1. Aerial image provided by Esri Online Services.

0 600
Feet

Publish Date: 2023/07/06, 2:27 PM | User: jlarson
Filepath: \\orcas\GIS\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 3
Wetland A - Map of the Contributing Basin
Wetland Rating Form - Wetland A
Freeman Road Logistics

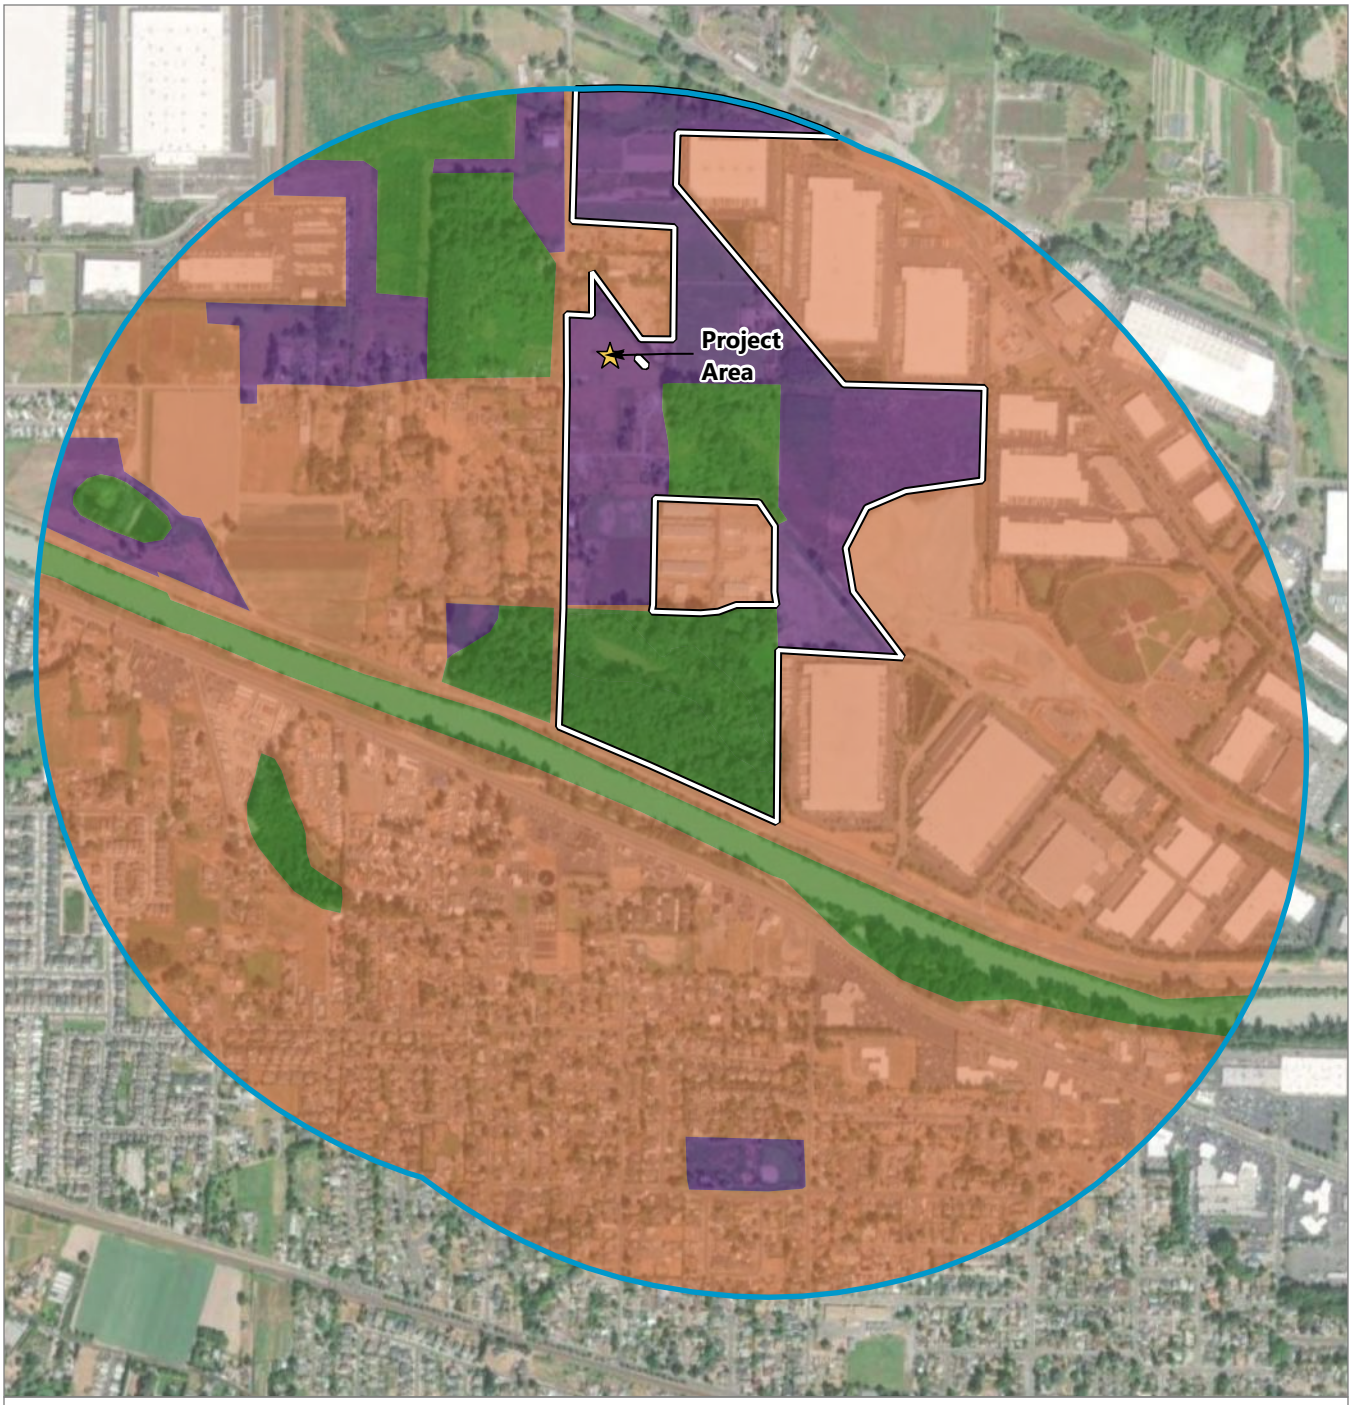

LEGEND:

- Project Area
- 1-km Radius of Wetland A
- Acessible Habitat

Land Use Type

- High Intensity
- Low/Moderate Intensity
- Relatively Undisturbed


NOTE:
1. Aerial image provided by Esri Online Services.

0 1,200
Feet

Publish Date: 2023/07/06, 4:52 PM | User: jlarson
Filepath: \\orcas\GIS\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\CAR\FreemanRoad_CAR.aprx

ANCHOR QEA

Figure 4
Land Use Intensity Within 1-km of the Wetland
Wetland Rating Form - Wetland A
Freeman Road Logistics

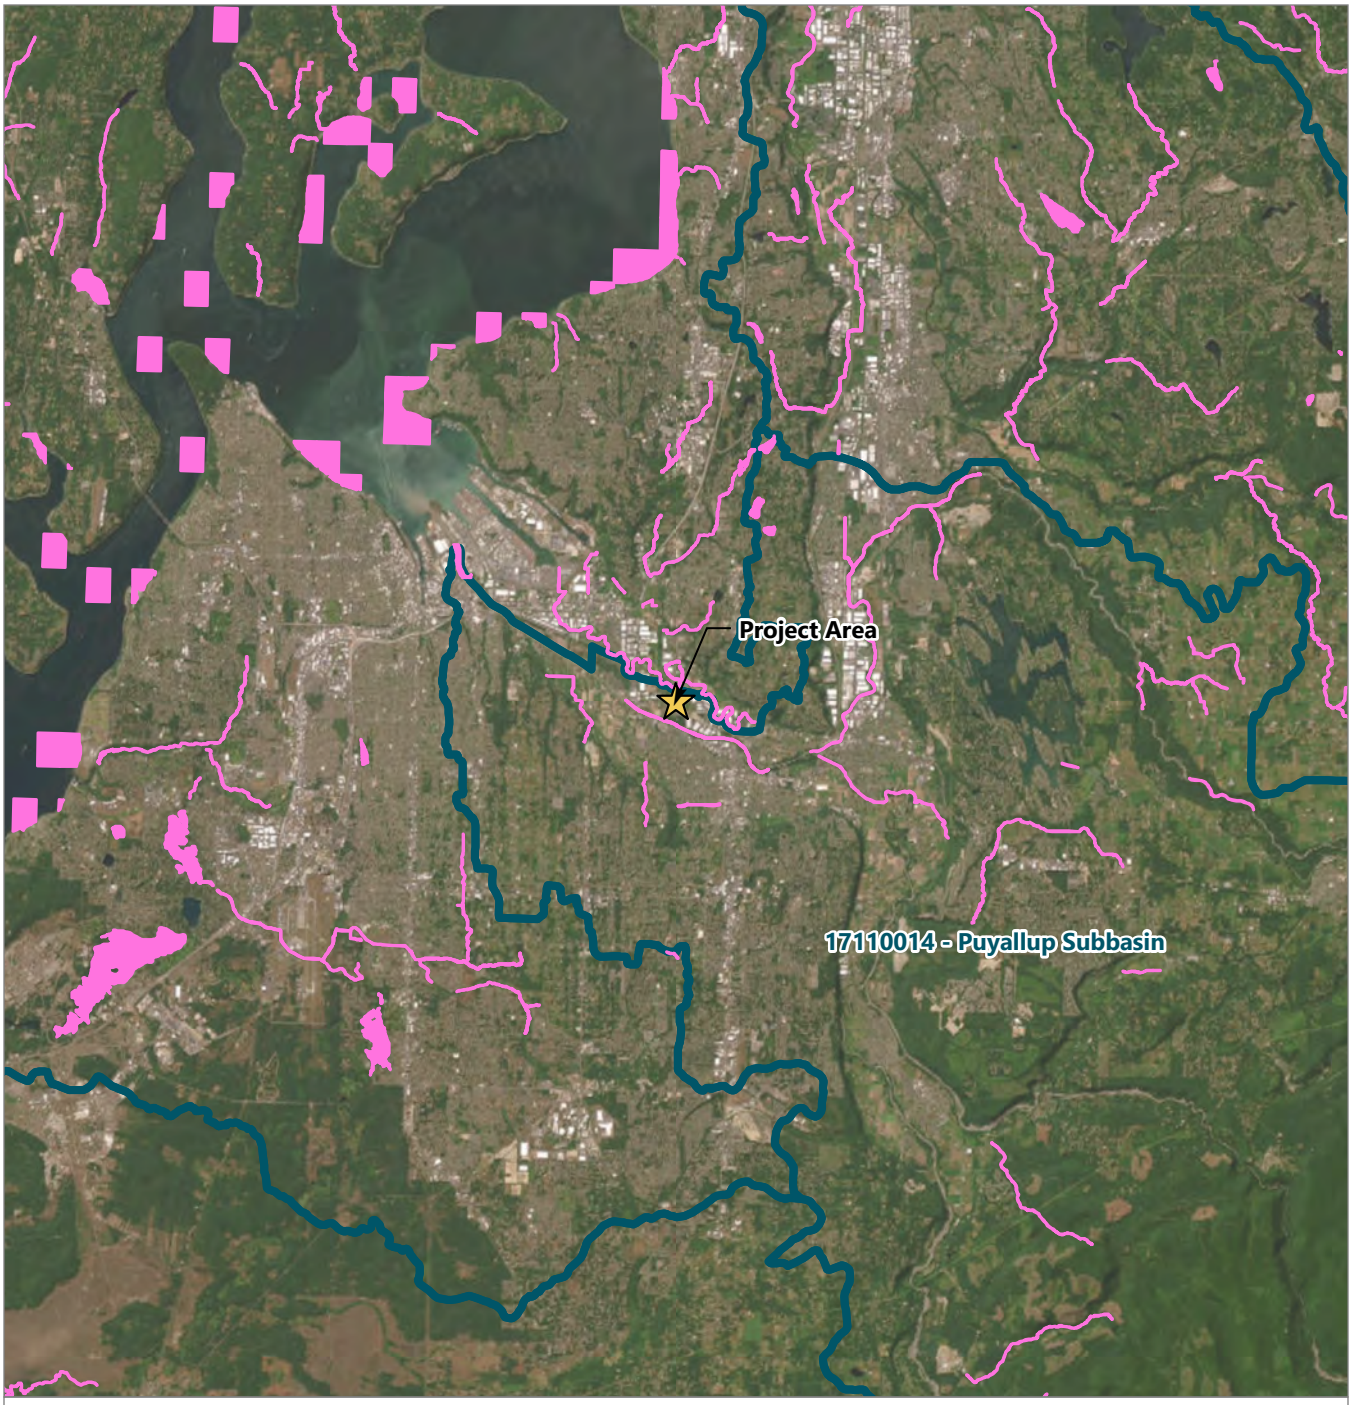

LEGEND:

- Project Area
- 303(d) Listed Water
- HUC8 Watershed


NOTES:
1. Aerial image provided by Esri Online Services.
2. 303(d) lised waters and HUC8 Watershed boundary from Washington State Ecology.

0 4
Miles

Publish Date: 2023/05/25, 10:52 AM | User: alesueur
Filepath: \\orcas\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\Wetlands\Ratings_WetlandB\WetlandB_Ratings.aprx

ANCHOR QEA

Figure 5
303(d) Listed Waters
Wetland Rating Form - Wetland A
Freeman Road Logistics

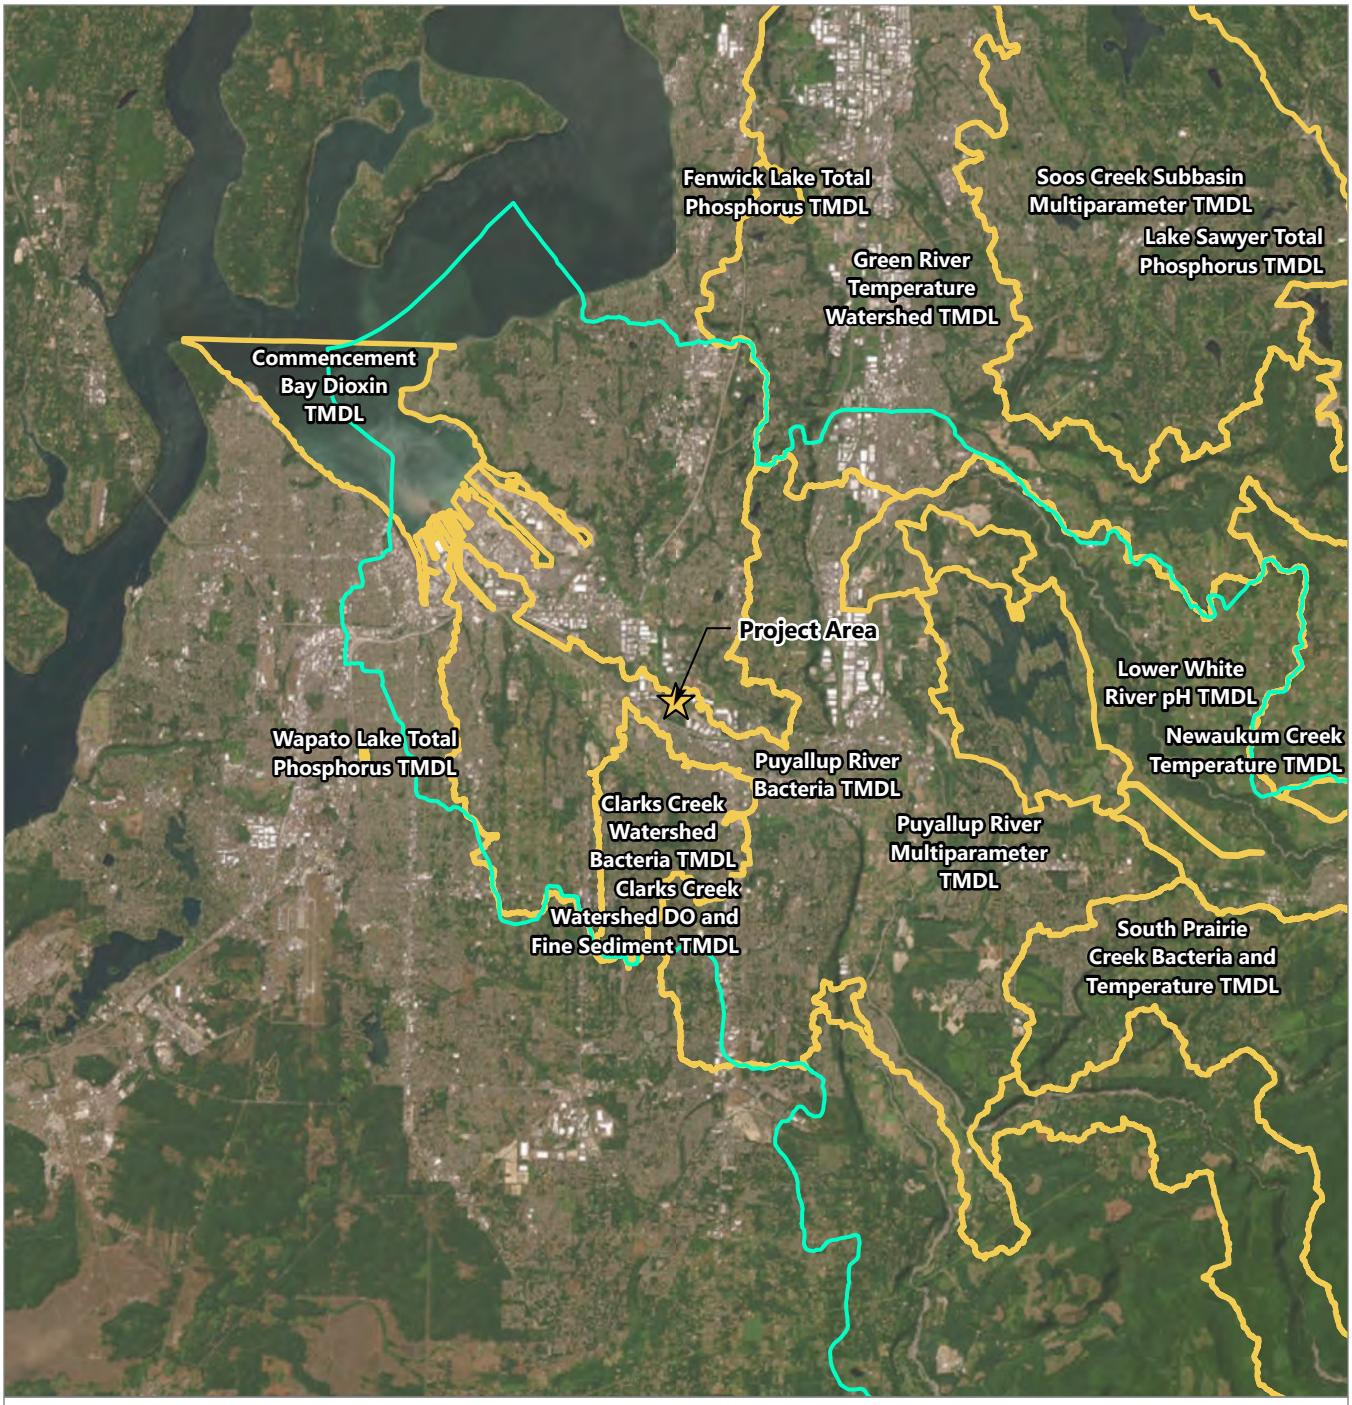

LEGEND:

- Project Area
- WRIA 10 - Puyallup - White
- TMDL

NOTES:
1. Aerial image provided by Esri Online Services.
2. WRIA 10 and TMDL boundaries are from Washington State Ecology.

0 4
Miles

Publish Date: 2023/05/25, 10:51 AM | User: alesueur
Filepath: \\orcas\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\Wetlands\Ratings_WetlandB\WetlandB_Ratings.aprx

ANCHOR QEA

Figure 6
List of TMDLs for WRIA 10 - Puyallup - White
Wetland Rating Form - Wetland A
Freeman Road Logistics

Appendix C-4
Wetland B Rating

Wetland name or number B

RATING SUMMARY – Western Washington

Name of wetland (or ID #): On-site Wetland B Date of site visit: 5/20/23

Rated by Hannah Fotherby, Jakob Rowny Trained by Ecology? X Yes ___No Date of training 12/8/22

HGM Class used for rating Depressional Wetland has multiple HGM classes?___Y X N

NOTE: **Form is not complete without the figures requested** *(figures can be combined)*.
Source of base aerial photo/map ESRI

OVERALL WETLAND CATEGORY III (based on functions X or special characteristics___)

1. Category of wetland based on FUNCTIONS

_____**Category I** – Total score = 23 - 27

_____**Category II** – Total score = 20 - 22

X **Category III** – Total score = 16 - 19

_____**Category IV** – Total score = 9 - 15

FUNCTION	Improving Water Quality	Hydrologic	Habitat	
	Circle the appropriate ratings			
Site Potential	H (M) L	H (M) L	H M (L)	
Landscape Potential	H (M) L	H (M) L	H M (L)	
Value	(H) M L	(H) M L	(H) M L	**TOTAL**
Score Based on Ratings	7	7	5	19

Score for each function based on three ratings *(order of ratings is not important)*

9 = H,H,H
8 = H,H,M
7 = H,H,L
7 = H,M,M
6 = H,M,L
6 = M,M,M
5 = H,L,L
5 = M,M,L
4 = M,L,L
3 = L,L,L

2. Category based on SPECIAL CHARACTERISTICS of wetland

CHARACTERISTIC	CATEGORY
Estuarine	**I II**
Wetland of High Conservation Value	**I**
Bog	**I**
Mature Forest	**I**
Old Growth Forest	**I**
Coastal Lagoon	**I II**
Interdunal	**I II III IV**
None of the above	X

Wetland name or number B

Maps and figures required to answer questions correctly for Western Washington

Depressional Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	D 1.3, H 1.1, H 1.4	Figure 1
Hydroperiods	D 1.4, H 1.2	Figure 2
Location of outlet (*can be added to map of hydroperiods)*	D 1.1, D 4.1	Figure 2
Boundary of area within 150 ft of the wetland *(can be added to another figure)*	D 2.2, D 5.2	Figure 1
Map of the contributing basin	D 4.3, D 5.3	Figure 3
1 km Polygon: Area that extends 1 km from entire wetland edge - including polygons for accessible habitat and undisturbed habitat	H 2.1, H 2.2, H 2.3	Figure 4
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	D 3.1, D 3.2	Figure 5
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	D 3.3	Figure 6

Riverine Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	H 1.1, H 1.4	
Hydroperiods	H 1.2	
Ponded depressions	R 1.1	
Boundary of area within 150 ft of the wetland *(can be added to another figure)*	R 2.4	
Plant cover of trees, shrubs, and herbaceous plants	R 1.2, R 4.2	
Width of unit vs. width of stream *(can be added to another figure)*	R 4.1	
Map of the contributing basin	R 2.2, R 2.3, R 5.2	
1 km Polygon: Area that extends 1 km from entire wetland edge - including polygons for accessible habitat and undisturbed habitat	H 2.1, H 2.2, H 2.3	
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	R 3.1	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	R 3.2, R 3.3	

Lake Fringe Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	L 1.1, L 4.1, H 1.1, H 1.4	
Plant cover of trees, shrubs, and herbaceous plants	L 1.2	
Boundary of area within 150 ft of the wetland *(can be added to another figure)*	L 2.2	
1 km Polygon: Area that extends 1 km from entire wetland edge - including polygons for accessible habitat and undisturbed habitat	H 2.1, H 2.2, H 2.3	
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	L 3.1, L 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	L 3.3	

Slope Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	H 1.1, H 1.4	
Hydroperiods	H 1.2	
Plant cover of **dense** trees, shrubs, and herbaceous plants	S 1.3	
Plant cover of **dense, rigid** trees, shrubs, and herbaceous plants (*can be added to figure above)*	S 4.1	
Boundary of 150 ft buffer (can be added to another figure)	S 2.1, S 5.1	
1 km Polygon: Area that extends 1 km from entire wetland edge - including polygons for accessible habitat and undisturbed habitat	H 2.1, H 2.2, H 2.3	
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	S 3.1, S 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	S 3.3	

Wetland name or number B

HGM Classification of Wetlands in Western Washington

For questions 1-7, the criteria described must apply to the entire unit being rated.

If the hydrologic criteria listed in each question do not apply to the entire unit being rated, you probably have a unit with multiple HGM classes. In this case, identify which hydrologic criteria in questions 1-7 apply, and go to Question 8.

1. Are the water levels in the entire unit usually controlled by tides except during floods?

NO – go to 2 **YES** – the wetland class is **Tidal Fringe** – go to 1.1

1.1 Is the salinity of the water during periods of annual low flow below 0.5 ppt (parts per thousand)?

NO – Saltwater Tidal Fringe (Estuarine) **YES – Freshwater Tidal Fringe**
*If your wetland can be classified as a Freshwater Tidal Fringe use the forms for **Riverine** wetlands. If it is Saltwater Tidal Fringe it is an **Estuarine** wetland and is not scored. This method **cannot** be used to score functions for estuarine wetlands.*

2. The entire wetland unit is flat and precipitation is the only source (>90%) of water to it. Groundwater and surface water runoff are NOT sources of water to the unit.

NO – go to 3 **YES** – The wetland class is **Flats**
*If your wetland can be classified as a Flats wetland, use the form for **Depressional** wetlands.*

3. Does the entire wetland unit **meet all** of the following criteria?
___The vegetated part of the wetland is on the shores of a body of permanent open water (without any plants on the surface at any time of the year) at least 20 ac (8 ha) in size;
___At least 30% of the open water area is deeper than 6.6 ft (2 m).

NO – go to 4 **YES –** The wetland class is **Lake Fringe** (Lacustrine Fringe)

4. Does the entire wetland unit **meet all** of the following criteria?
___The wetland is on a slope (*slope can be very gradual*),
___The water flows through the wetland in one direction (unidirectional) and usually comes from seeps. It may flow subsurface, as sheetflow, or in a swale without distinct banks,
___The water leaves the wetland **without being impounded**.

NO – go to 5 **YES –** The wetland class is **Slope**

NOTE: Surface water does not pond in these type of wetlands except occasionally in very small and shallow depressions or behind hummocks (depressions are usually <3 ft diameter and less than 1 ft deep).

5. Does the entire wetland unit **meet all** of the following criteria?
___The unit is in a valley, or stream channel, where it gets inundated by overbank flooding from that stream or river,
___The overbank flooding occurs at least once every 2 years.

Wetland name or number B

NO – go to 6 **YES** – The wetland class is **Riverine**

NOTE: The Riverine unit can contain depressions that are filled with water when the river is not flooding

6. Is the entire wetland unit in a topographic depression in which water ponds, or is saturated to the surface, at some time during the year? *This means that any outlet, if present, is higher than the interior of the wetland.*

NO – go to 7 **YES** – The wetland class is **Depressional**

7. Is the entire wetland unit located in a very flat area with no obvious depression and no overbank flooding? The unit does not pond surface water more than a few inches. The unit seems to be maintained by high groundwater in the area. The wetland may be ditched, but has no obvious natural outlet.

NO – go to 8 **YES** – The wetland class is **Depressional**

8. Your wetland unit seems to be difficult to classify and probably contains several different HGM classes. For example, seeps at the base of a slope may grade into a riverine floodplain, or a small stream within a Depressional wetland has a zone of flooding along its sides. GO BACK AND IDENTIFY WHICH OF THE HYDROLOGIC REGIMES DESCRIBED IN QUESTIONS 1-7 APPLY TO DIFFERENT AREAS IN THE UNIT (make a rough sketch to help you decide). Use the following table to identify the appropriate class to use for the rating system if you have several HGM classes present within the wetland unit being scored.

   NOTE: Use this table only if the class that is recommended in the second column represents 10% or more of the total area of the wetland unit being rated. If the area of the HGM class listed in column 2 is less than 10% of the unit; classify the wetland using the class that represents more than 90% of the total area.

HGM classes within the wetland unit being rated	HGM class to use in rating
Slope + Riverine	Riverine
Slope + Depressional	Depressional
Slope + Lake Fringe	Lake Fringe
Depressional + Riverine along stream within boundary of depression	Depressional
Depressional + Lake Fringe	Depressional
Riverine + Lake Fringe	Riverine
Salt Water Tidal Fringe and any other class of freshwater wetland	Treat as ESTUARINE

*If you are still unable to determine which of the above criteria apply to your wetland, or if you have **more than 2 HGM classes** within a wetland boundary, classify the wetland as Depressional for the rating.*

Wetland name or number B

DEPRESSIONAL AND FLATS WETLANDS

Water Quality Functions - Indicators that the site functions to improve water quality

D 1.0. Does the site have the potential to improve water quality?	
D 1.1. Characteristics of surface water outflows from the wetland: Wetland is a depression or flat depression (QUESTION 7 on key) with no surface water leaving it (no outlet). points = 3 Wetland has an intermittently flowing stream or ditch, OR highly constricted permanently flowing outlet. points = 2 Wetland has an unconstricted, or slightly constricted, surface outlet that is permanently flowing points = 1 Wetland is a flat depression (QUESTION 7 on key), whose outlet is a permanently flowing ditch. points = 1	3
D 1.2. The soil 2 in below the surface (or duff layer) is true clay or true organic *(use NRCS definitions)*. Yes = 4 No = 0	0
D 1.3. Characteristics and distribution of persistent plants (Emergent, Scrub-shrub, and/or Forested Cowardin classes): Wetland has persistent, ungrazed, plants > 95% of area points = 5 Wetland has persistent, ungrazed, plants > ½ of area points = 3 Wetland has persistent, ungrazed plants > $^1/_{10}$ of area points = 1 Wetland has persistent, ungrazed plants < $^1/_{10}$ of area points = 0	5
D 1.4. Characteristics of seasonal ponding or inundation: *This is the area that is ponded for at least 2 months. See description in manual.* Area seasonally ponded is > ½ total area of wetland points = 4 Area seasonally ponded is > ¼ total area of wetland points = 2 Area seasonally ponded is < ¼ total area of wetland points = 0	2
Total for D 1 Add the points in the boxes above	10

Rating of Site Potential If score is: ___ **12-16 = H** X **6-11 = M** ___ **0-5 = L** *Record the rating on the first page*

D 2.0. Does the landscape have the potential to support the water quality function of the site?	
D 2.1. Does the wetland unit receive stormwater discharges? Yes = 1 No = 0	0
D 2.2. Is > 10% of the area within 150 ft of the wetland in land uses that generate pollutants? Yes = 1 No = 0	1
D 2.3. Are there septic systems within 250 ft of the wetland? houses are gone but septic may still be leaching Yes = 1 No = 0	1
D 2.4. Are there other sources of pollutants coming into the wetland that are not listed in questions D 2.1-D 2.3? Source_____ Yes = 1 No = 0	0
Total for D 2 Add the points in the boxes above	2

Rating of Landscape Potential If score is: ___ **3 or 4 = H** X **1 or 2 = M** ___ **0 = L** *Record the rating on the first page*

D 3.0. Is the water quality improvement provided by the site valuable to society?	
D 3.1. Does the wetland discharge directly (i.e., within 1 mi) to a stream, river, lake, or marine water that is on the 303(d) list? Yes = 1 No = 0	0
D 3.2. Is the wetland in a basin or sub-basin where an aquatic resource is on the 303(d) list? Yes = 1 No = 0	1
D 3.3. Has the site been identified in a watershed or local plan as important for maintaining water quality (*answer YES if there is a TMDL for the basin in which the unit is found*)? Yes = 2 No = 0	2
Total for D 3 Add the points in the boxes above	3

Rating of Value If score is: X **2-4 = H** ___ **1 = M** ___ **0 = L** *Record the rating on the first page*

Wetland name or number B

DEPRESSIONAL AND FLATS WETLANDS

Hydrologic Functions - Indicators that the site functions to reduce flooding and stream degradation

D 4.0. Does the site have the potential to reduce flooding and erosion?

D 4.1. Characteristics of surface water outflows from the wetland: Wetland is a depression or flat depression with no surface water leaving it (no outlet) points = 4 Wetland has an intermittently flowing stream or ditch, OR highly constricted permanently flowing outlet points = 2 Wetland is a flat depression (QUESTION 7 on key), whose outlet is a permanently flowing ditch points = 1 Wetland has an unconstricted, or slightly constricted, surface outlet that is permanently flowing points = 0	4
D 4.2. Depth of storage during wet periods: *Estimate the height of ponding above the bottom of the outlet. For wetlands with no outlet, measure from the surface of permanent water or if dry, the deepest part.* Marks of ponding are 3 ft or more above the surface or bottom of outlet points = 7 Marks of ponding between 2 ft to < 3 ft from surface or bottom of outlet points = 5 Marks are at least 0.5 ft to < 2 ft from surface or bottom of outlet points = 3 The wetland is a "headwater" wetland points = 3 Wetland is flat but has small depressions on the surface that trap water points = 1 Marks of ponding less than 0.5 ft (6 in) points = 0	0
D 4.3. Contribution of the wetland to storage in the watershed: *Estimate the ratio of the area of upstream basin contributing surface water to the wetland to the area of the wetland unit itself.* The area of the basin is less than 10 times the area of the unit points = 5 The area of the basin is 10 to 100 times the area of the unit points = 3 The area of the basin is more than 100 times the area of the unit points = 0 Entire wetland is in the Flats class points = 5	5
Total for D 4 Add the points in the boxes above	9

Rating of Site Potential If score is: ___ **12-16 = H** X **6-11 = M** ___ **0-5 = L** *Record the rating on the first page*

D 5.0. Does the landscape have the potential to support hydrologic functions of the site?

D 5.1. Does the wetland receive stormwater discharges? Yes = 1 No = 0	0
D 5.2. Is >10% of the area within 150 ft of the wetland in land uses that generate excess runoff? Yes = 1 No = 0	1
D 5.3. Is more than 25% of the contributing basin of the wetland covered with intensive human land uses (residential at >1 residence/ac, urban, commercial, agriculture, etc.)? Yes = 1 No = 0	0
Total for D 5 Add the points in the boxes above	1

Rating of Landscape Potential If score is: ___ **3 = H** X **1 or 2 = M** ___ **0 = L** *Record the rating on the first page*

D 6.0. Are the hydrologic functions provided by the site valuable to society?

D 6.1. The unit is in a landscape that has flooding problems. *Choose the description that best matches conditions around the wetland unit being rated. Do not add points. Choose the highest score if more than one condition is met.* The wetland captures surface water that would otherwise flow down-gradient into areas where flooding has damaged human or natural resources (e.g., houses or salmon redds): • Flooding occurs in a sub-basin that is immediately down-gradient of unit. points = 2 • Surface flooding problems are in a sub-basin farther down-gradient. points = 1 Flooding from groundwater is an issue in the sub-basin. points = 1 The existing or potential outflow from the wetland is so constrained by human or natural conditions that the water stored by the wetland cannot reach areas that flood. *Explain why* _____ points = 0 There are no problems with flooding downstream of the wetland. points = 0	2
D 6.2. Has the site been identified as important for flood storage or flood conveyance in a regional flood control plan? Yes = 2 No = 0	0
Total for D 6 Add the points in the boxes above	2

Rating of Value If score is: X **2-4 = H** ___ **1 = M** ___ **0 = L** *Record the rating on the first page*

Wetland name or number B

These questions apply to wetlands of all HGM classes.

HABITAT FUNCTIONS - Indicators that site functions to provide important habitat

H 1.0. Does the site have the potential to provide habitat?

H 1.1. Structure of plant community: *Indicators are Cowardin classes and strata within the Forested class.* Check the Cowardin plant classes in the wetland. *Up to 10 patches may be combined for each class to meet the threshold of ¼ ac or more than 10% of the unit if it is smaller than 2.5 ac. Add the number of structures checked.*

____Aquatic bed	4 structures or more: points = 4
_X_Emergent	3 structures: points = 2
____Scrub-shrub (areas where shrubs have > 30% cover)	2 structures: points = 1
____Forested (areas where trees have > 30% cover)	1 structure: points = 0

If the unit has a Forested class, check if:

____The Forested class has 3 out of 5 strata (canopy, sub-canopy, shrubs, herbaceous, moss/ground-cover) that each cover 20% within the Forested polygon

0

H 1.2. Hydroperiods

Check the types of water regimes (hydroperiods) present within the wetland. The water regime has to cover more than 10% of the wetland or ¼ ac to count (*see text for descriptions of hydroperiods*).

____Permanently flooded or inundated	4 or more types present: points = 3
_X_Seasonally flooded or inundated	3 types present: points = 2
____Occasionally flooded or inundated	2 types present: points = 1
_X_Saturated only	1 type present: points = 0
____Permanently flowing stream or river in, or adjacent to, the wetland	
____Seasonally flowing stream in, or adjacent to, the wetland	
____**Lake Fringe wetland**	**2 points**
____**Freshwater tidal wetland**	**2 points**

1

H 1.3. Richness of plant species

Count the number of plant species in the wetland that cover at least 10 ft^2.


Different patches of the same species can be combined to meet the size threshold and you do not have to name the species. ***Do not include Eurasian milfoil, reed canarygrass, purple loosestrife, Canadian thistle***

If you counted: > 19 species	*Alopecurus pratensis*, *Ranunculus repens*, *Trifolium repens*, *Juncus effusus*	points = 2
5 - 19 species		points = 1
< 5 species		points = 0


0

H 1.4. Interspersion of habitats


Decide from the diagrams below whether interspersion among Cowardin plants classes (described in H 1.1), or the classes and unvegetated areas (can include open water or mudflats) is high, moderate, low, or none. *If you have four or more plant classes or three classes and open water, the rating is always high.*



None = 0 points




Low = 1 point

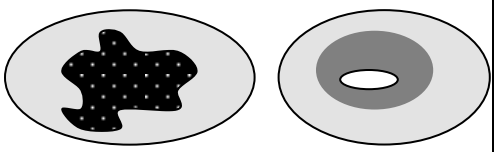

Moderate = 2 points

All three diagrams in this row are **HIGH** = 3points

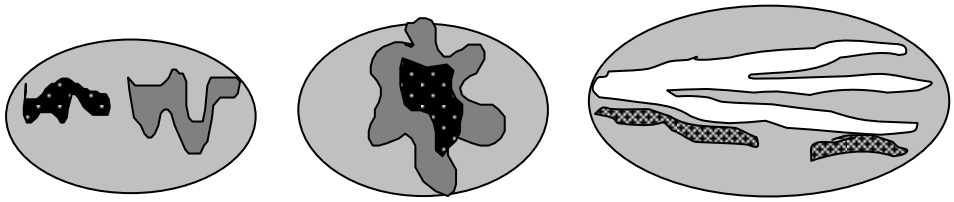

0

Wetland name or number B

H 1.5. Special habitat features: Check the habitat features that are present in the wetland. *The number of checks is the number of points.* ____Large, downed, woody debris within the wetland (> 4 in diameter and 6 ft long). ____Standing snags (dbh > 4 in) within the wetland ____Undercut banks are present for at least 6.6 ft (2 m) **and/or** overhanging plants extends at least 3.3 ft (1 m) over a stream (or ditch) in, or contiguous with the wetland, for at least 33 ft (10 m) ____Stable steep banks of fine material that might be used by beaver or muskrat for denning (> 30 degree slope) OR signs of recent beaver activity are present *(cut shrubs or trees that have not yet weathered where wood is exposed)* ____At least ¼ ac of thin-stemmed persistent plants or woody branches are present in areas that are permanently or seasonally inundated *(structures for egg-laying by amphibians)* __X__Invasive plants cover less than 25% of the wetland area in every stratum of plants (*see H 1.1 for list of strata*)	*1*
Total for H 1 Add the points in the boxes above	*2*

Rating of Site Potential If score is:___**15-18 = H** ___**7-14 = M** __X__**0-6 = L** *Record the rating on the first page*

H 2.0. Does the landscape have the potential to support the habitat functions of the site?	
H 2.1. Accessible habitat (include *only habitat that directly abuts wetland unit*). *Calculate:* % undisturbed habitat 6 **+** [(% moderate and low intensity land uses)/2] 6 **=** 12 % If total accessible habitat is: > 1/3 (33.3%) of 1 km Polygon points = 3 20-33% of 1 km Polygon points = 2 10-19% of 1 km Polygon points = 1 < 10% of 1 km Polygon points = 0	1
H 2.2. Undisturbed habitat in 1 km Polygon around the wetland. *Calculate:* % undisturbed habitat 18 **+** [(% moderate and low intensity land uses)/2] 12 **=** 30 % Undisturbed habitat > 50% of Polygon points = 3 Undisturbed habitat 10-50% and in 1-3 patches points = 2 Undisturbed habitat 10-50% and > 3 patches points = 1 Undisturbed habitat < 10% of 1 km Polygon points = 0	1
H 2.3. Land use intensity in 1 km Polygon: If > 50% of 1 km Polygon is high intensity land use points = (- 2) ≤ 50% of 1 km Polygon is high intensity points = 0	-2
Total for H 2 Add the points in the boxes above	0

Rating of Landscape Potential If score is:___**4-6 = H** ___**1-3 = M** __X__**< 1 = L** *Record the rating on the first page*

H 3.0. Is the habitat provided by the site valuable to society?	
H 3.1. Does the site provide habitat for species valued in laws, regulations, or policies? *Choose only the highest score that applies to the wetland being rated.* Site meets ANY of the following criteria: points = 2 __X__ It has 3 or more priority habitats within 100 m (see next page) ___ It provides habitat for Threatened or Endangered species (any plant or animal on the state or federal lists) ___ It is mapped as a location for an individual WDFW priority species ___ It is a Wetland of High Conservation Value as determined by the Department of Natural Resources ___ It has been categorized as an important habitat site in a local or regional comprehensive plan, in a Shoreline Master Plan, or in a watershed plan Site has 1 or 2 priority habitats (listed on next page) within 100 m points = 1 Site does not meet any of the criteria above points = 0	*2*

Rating of Value If score is: X **2 = H** ___**1 = M** ___**0 = L** *Record the rating on the first page*

Wetland name or number B

WDFW Priority Habitats

Priority habitats listed by WDFW (see complete descriptions of WDFW priority habitats, and the counties in which they can be found, in: Washington Department of Fish and Wildlife. 2008. Priority Habitat and Species List. Olympia, Washington. 177 pp. http://wdfw.wa.gov/publications/00165/wdfw00165.pdf or access the list from here: http://wdfw.wa.gov/conservation/phs/list/)

Count how many of the following priority habitats are within 330 ft (100 m) of the wetland unit: ***NOTE:*** *This question is independent of the land use between the wetland unit and the priority habitat.*

— **Aspen Stands:** Pure or mixed stands of aspen greater than 1 ac (0.4 ha).

— **Biodiversity Areas and Corridors**: Areas of habitat that are relatively important to various species of native fish and wildlife (*full descriptions in WDFW PHS report*).

— **Herbaceous Balds:** Variable size patches of grass and forbs on shallow soils over bedrock.

— **Old-growth/Mature forests:** Old-growth west of Cascade crest – Stands of at least 2 tree species, forming a multi-layered canopy with occasional small openings; with at least 8 trees/ac (20 trees/ha) > 32 in (81 cm) dbh or > 200 years of age. Mature forests – Stands with average diameters exceeding 21 in (53 cm) dbh; crown cover may be less than 100%; decay, decadence, numbers of snags, and quantity of large downed material is generally less than that found in old-growth; 80-200 years old west of the Cascade crest.

— **Oregon White Oak:** Woodland stands of pure oak or oak/conifer associations where canopy coverage of the oak component is important (*full descriptions in WDFW PHS report p. 158 – see web link above*).

X — **Riparian**: The area adjacent to aquatic systems with flowing water that contains elements of both aquatic and terrestrial ecosystems which mutually influence each other.

— **Westside Prairies:** Herbaceous, non-forested plant communities that can either take the form of a dry prairie or a wet prairie (*full descriptions in WDFW PHS report p. 161 – see web link above*).

X — **Instream:** The combination of physical, biological, and chemical processes and conditions that interact to provide functional life history requirements for instream fish and wildlife resources.

— **Nearshore**: Relatively undisturbed nearshore habitats. These include Coastal Nearshore, Open Coast Nearshore, and Puget Sound Nearshore. (*full descriptions of habitats and the definition of relatively undisturbed are in WDFW report – see web link on previous page).*

— **Caves:** A naturally occurring cavity, recess, void, or system of interconnected passages under the earth in soils, rock, ice, or other geological formations and is large enough to contain a human.

— **Cliffs:** Greater than 25 ft (7.6 m) high and occurring below 5000 ft elevation.

— **Talus:** Homogenous areas of rock rubble ranging in average size 0.5 - 6.5 ft (0.15 - 2.0 m), composed of basalt, andesite, and/or sedimentary rock, including riprap slides and mine tailings. May be associated with cliffs.

X — **Snags and Logs:** Trees are considered snags if they are dead or dying and exhibit sufficient decay characteristics to enable cavity excavation/use by wildlife. Priority snags have a diameter at breast height of > 20 in (51 cm) in western Washington and are > 6.5 ft (2 m) in height. Priority logs are > 12 in (30 cm) in diameter at the largest end, and > 20 ft (6 m) long.

Note: All vegetated wetlands are by definition a priority habitat but are not included in this list because they are addressed elsewhere.

Wetland name or number B

CATEGORIZATION BASED ON SPECIAL CHARACTERISTICS

Wetland Type *Check off any criteria that apply to the wetland. Circle the category when the appropriate criteria are met.*	**Category**
SC 1.0. Estuarine wetlands Does the wetland meet the following criteria for Estuarine wetlands? — The dominant water regime is tidal, — Vegetated, and — With a salinity greater than 0.5 ppt Yes –Go to **SC 1.1** No= **Not an estuarine wetland**	
SC 1.1. Is the wetland within a National Wildlife Refuge, National Park, National Estuary Reserve, Natural Area Preserve, State Park or Educational, Environmental, or Scientific Reserve designated under WAC 332-30-151? Yes = **Category I** No - Go to **SC 1.2**	**Cat. I**
SC 1.2. Is the wetland unit at least 1 ac in size and meets at least two of the following three conditions? — The wetland is relatively undisturbed (has no diking, ditching, filling, cultivation, grazing, and has less than 10% cover of non-native plant species. (If non-native species are *Spartina*, see page 25) — At least ¾ of the landward edge of the wetland has a 100 ft buffer of shrub, forest, or un-grazed or un-mowed grassland. — The wetland has at least two of the following features: tidal channels, depressions with open water, or contiguous freshwater wetlands. Yes = **Category I** No = **Category II**	**Cat. I** **Cat. II**
SC 2.0. Wetlands of High Conservation Value (WHCV) SC 2.1. Has the WA Department of Natural Resources updated their website to include the list of Wetlands of High Conservation Value? Yes – Go to **SC 2.2** No – Go to **SC 2.3** SC 2.2. Is the wetland listed on the WDNR database as a Wetland of High Conservation Value? Yes = **Category I** No = **Not a WHCV** SC 2.3. Is the wetland in a Section/Township/Range that contains a Natural Heritage wetland? http://www1.dnr.wa.gov/nhp/refdesk/datasearch/wnhpwetlands.pdf Yes **– Contact WNHP/WDNR and go to SC 2.4** No = **Not a WHCV** SC 2.4. Has WDNR identified the wetland within the S/T/R as a Wetland of High Conservation Value and listed it on their website? Yes = **Category I** No = **Not a WHCV**	**Cat. I**
SC 3.0. Bogs Does the wetland (or any part of the unit) meet both the criteria for soils and vegetation in bogs? *Use the key below.* ***If you answer YES you will still need to rate the wetland based on its functions.*** SC 3.1. Does an area within the wetland unit have organic soil horizons, either peats or mucks, that compose 16 in or more of the first 32 in of the soil profile? Yes – Go to **SC 3.3** No – Go to **SC 3.2** SC 3.2. Does an area within the wetland unit have organic soils, either peats or mucks, that are less than 16 in deep over bedrock, or an impermeable hardpan such as clay or volcanic ash, or that are floating on top of a lake or pond? Yes – Go to **SC 3.3** No = **Is not a bog** SC 3.3. Does an area with peats or mucks have more than 70% cover of mosses at ground level, AND at least a 30% cover of plant species listed in Table 4? Yes = **Is a Category I bog** No – Go to **SC 3.4** **NOTE:** If you are uncertain about the extent of mosses in the understory, you may substitute that criterion by measuring the pH of the water that seeps into a hole dug at least 16 in deep. If the pH is less than 5.0 and the plant species in Table 4 are present, the wetland is a bog. SC 3.4. Is an area with peats or mucks forested (> 30% cover) with Sitka spruce, subalpine fir, western red cedar, western hemlock, lodgepole pine, quaking aspen, Engelmann spruce, or western white pine, AND any of the species (or combination of species) listed in Table 4 provide more than 30% of the cover under the canopy? Yes = **Is a Category I bog** No = **Is not a bog**	**Cat. I**

Wetland name or number B

SC 4.0. Forested Wetlands Does the wetland have at least 1 contiguous acre of forest that meets one of these criteria for the WA Department of Fish and Wildlife's forests as priority habitats? ***If you answer YES you will still need to rate the wetland based on its functions.*** — **Old-growth forests** (west of Cascade crest): Stands of at least two tree species, forming a multi-layered canopy with occasional small openings; with at least 8 trees/ac (20 trees/ha) that are at least 200 years of age OR have a diameter at breast height (dbh) of 32 in (81 cm) or more. — **Mature forests** (west of the Cascade Crest): Stands where the largest trees are 80- 200 years old OR the species that make up the canopy have an average diameter (dbh) exceeding 21 in (53 cm). Yes = **Category I** No = **Not a forested wetland for this section**	**Cat. I**
SC 5.0. Wetlands in Coastal Lagoons Does the wetland meet all of the following criteria of a wetland in a coastal lagoon? — The wetland lies in a depression adjacent to marine waters that is wholly or partially separated from marine waters by sandbanks, gravel banks, shingle, or, less frequently, rocks — The lagoon in which the wetland is located contains ponded water that is saline or brackish (> 0.5 ppt) during most of the year in at least a portion of the lagoon *(needs to be measured near the bottom)* Yes – Go to **SC 5.1** No = **Not a wetland in a coastal lagoon** SC 5.1. Does the wetland meet all of the following three conditions? — The wetland is relatively undisturbed (has no diking, ditching, filling, cultivation, grazing), and has less than 20% cover of aggressive, opportunistic plant species (see list of species on p. 100). — At least ¾ of the landward edge of the wetland has a 100 ft buffer of shrub, forest, or un-grazed or un-mowed grassland. — The wetland is larger than $^{1}/_{10}$ ac (4350 ft^2) Yes = **Category I** No = **Category II**	**Cat. I** **Cat. II**
SC 6.0. Interdunal Wetlands Is the wetland west of the 1889 line (also called the Western Boundary of Upland Ownership or WBUO)? ***If you answer yes you will still need to rate the wetland based on its habitat functions.*** In practical terms that means the following geographic areas: — Long Beach Peninsula: Lands west of SR 103 — Grayland-Westport: Lands west of SR 105 — Ocean Shores-Copalis: Lands west of SR 115 and SR 109 Yes – Go to **SC 6.1** No = **not an interdunal wetland for rating** SC 6.1. Is the wetland 1 ac or larger and scores an 8 or 9 for the habitat functions on the form (rates H,H,H or H,H,M for the three aspects of function)? Yes = **Category I** No – Go to **SC 6.2** SC 6.2. Is the wetland 1 ac or larger, or is it in a mosaic of wetlands that is 1 ac or larger? Yes = **Category II** No – Go to **SC 6.3** SC 6.3. Is the unit between 0.1 and 1 ac, or is it in a mosaic of wetlands that is between 0.1 and 1 ac? Yes = **Category III** No = **Category IV**	**Cat I** **Cat. II** **Cat. III** **Cat. IV**
Category of wetland based on Special Characteristics If you answered No for all types, enter "Not Applicable" on Summary Form	N/A

This page left blank intentionally

Appendix C-5
Wetland B Figures



LEGEND:

150-foot Buffer of Wetland B

Pollutant Generating Area

Cowardin Class

Palustrine Emergent

NOTES:
1. Aerial image provided by Esri Online Services.

0 100
Feet

Publish Date: 2023/05/25, 2:36 PM | User: alesueur
Filepath: \\orcas\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\Wetlands\Ratings_WetlandB\WetlandB_Ratings.aprx

ANCHOR QEA

Figure 1
Cowardin Plant Classes and Area Within 150-feet of the Wetland
Wetland Rating Form - Wetland B
Freeman Road Logistics



LEGEND:

Wetland B

Hydroperiods

Saturated

Seasonally Flooded

NOTES:

1. Aerial image provided by Esri Online Services.

0 40

Feet

Publish Date: 2023/05/25, 10:47 AM | User: alesueur

Filepath: \\orcas\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\Wetlands\Ratings_WetlandB\WetlandB_Ratings.aprx

ANCHOR QEA

Figure 2

Hydroperiods

Wetland Rating Form - Wetland B

Freeman Road Logistics



LEGEND:

- Wetland B
- Contributing Basin


NOTES:
1. Aerial image provided by Esri Online Services.
2. Hillshade background from Washington Department of Natural Resources, Pierce County Lidar, 2020.

0 200
Feet

Publish Date: 2023/05/25, 2:23 PM | User: alesueur
Filepath: \\orcas\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\Wetlands\Ratings_WetlandB\WetlandB_Ratings.aprx

ANCHOR QEA

Figure 3
Contributing Basin
Wetland Rating Form - Wetland B
Freeman Road Logistics

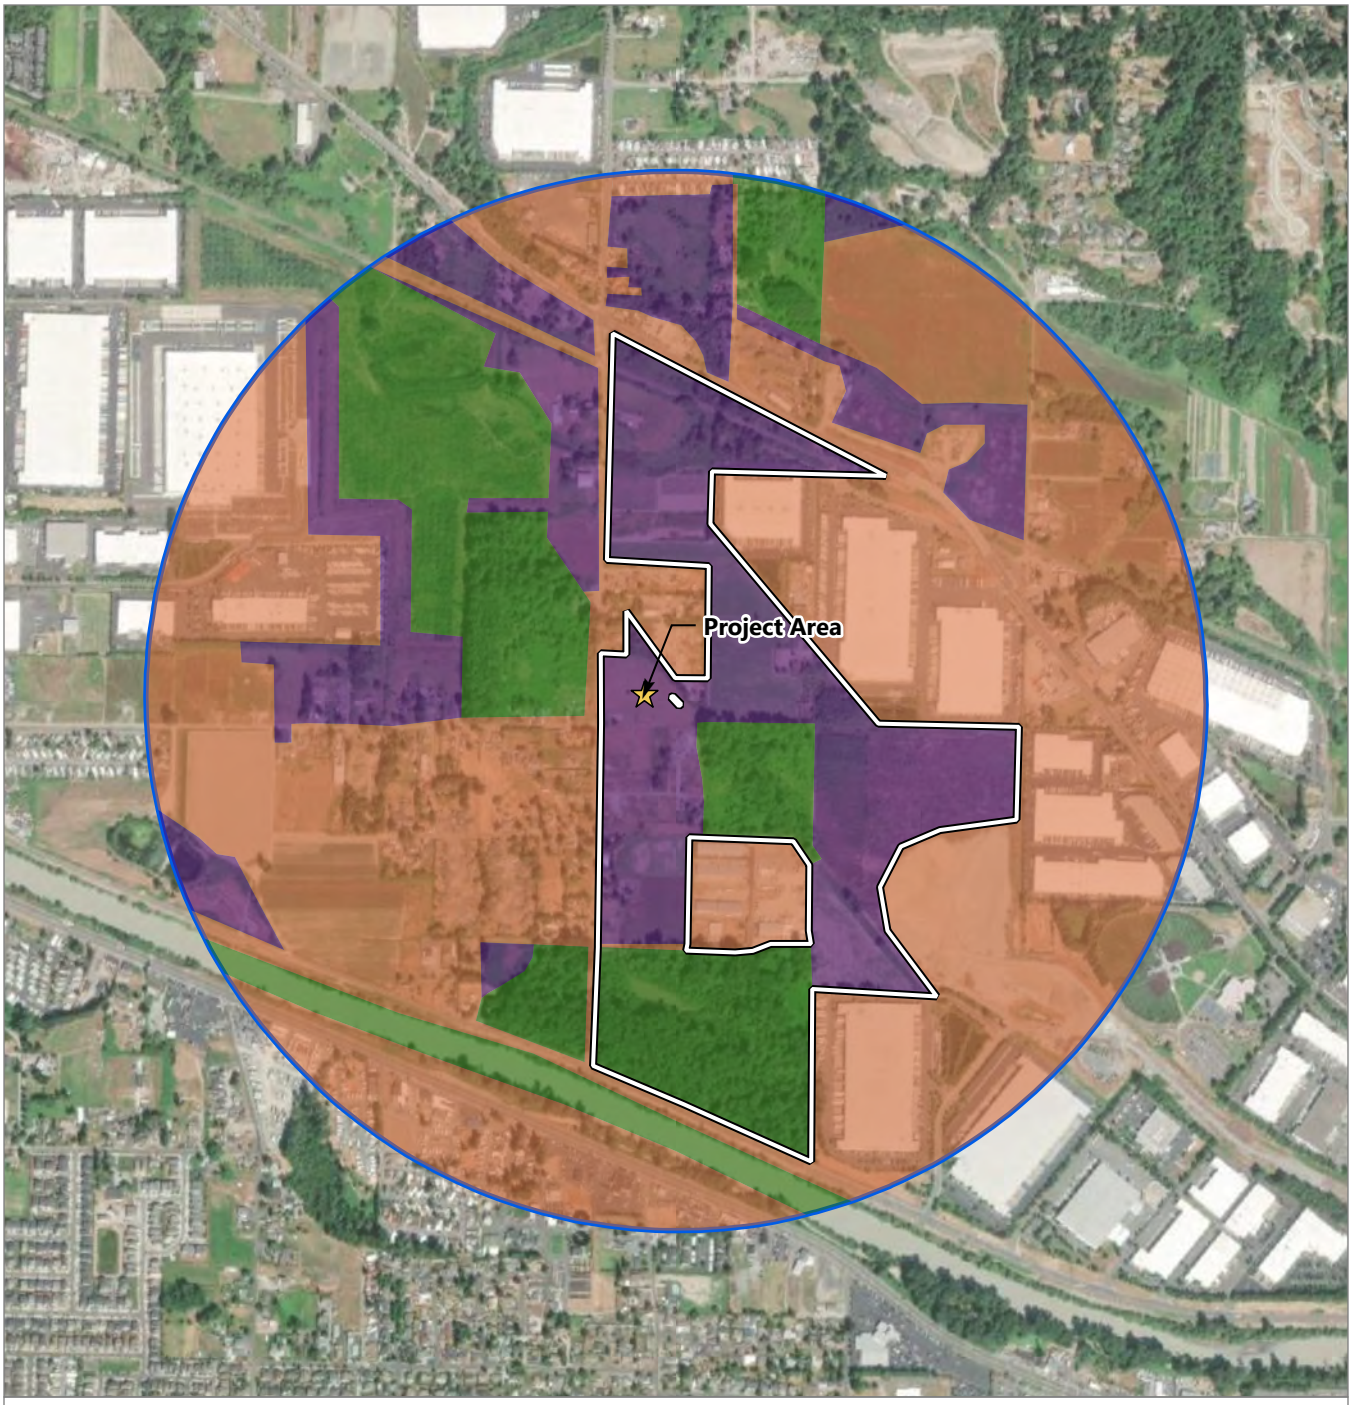

LEGEND:

- Project Area
- 1-km Radius of Wetland B
- Accessible Habitat

Land Use Type

- High Intensity
- Low/Moderate Intensity
- Relatively Undisturbed


NOTES:
1. Aerial image provided by Esri Online Services.

0 1,200
Feet

Publish Date: 2023/05/25, 2:48 PM | User: alesueur
Filepath: \\orcas\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\Wetlands\Ratings_WetlandB\WetlandB_Ratings.aprx

ANCHOR QEA

Figure 4
Land Use Intensity within 1-km of the Wetland
Wetland Rating Form - Wetland B
Freeman Road Logistics

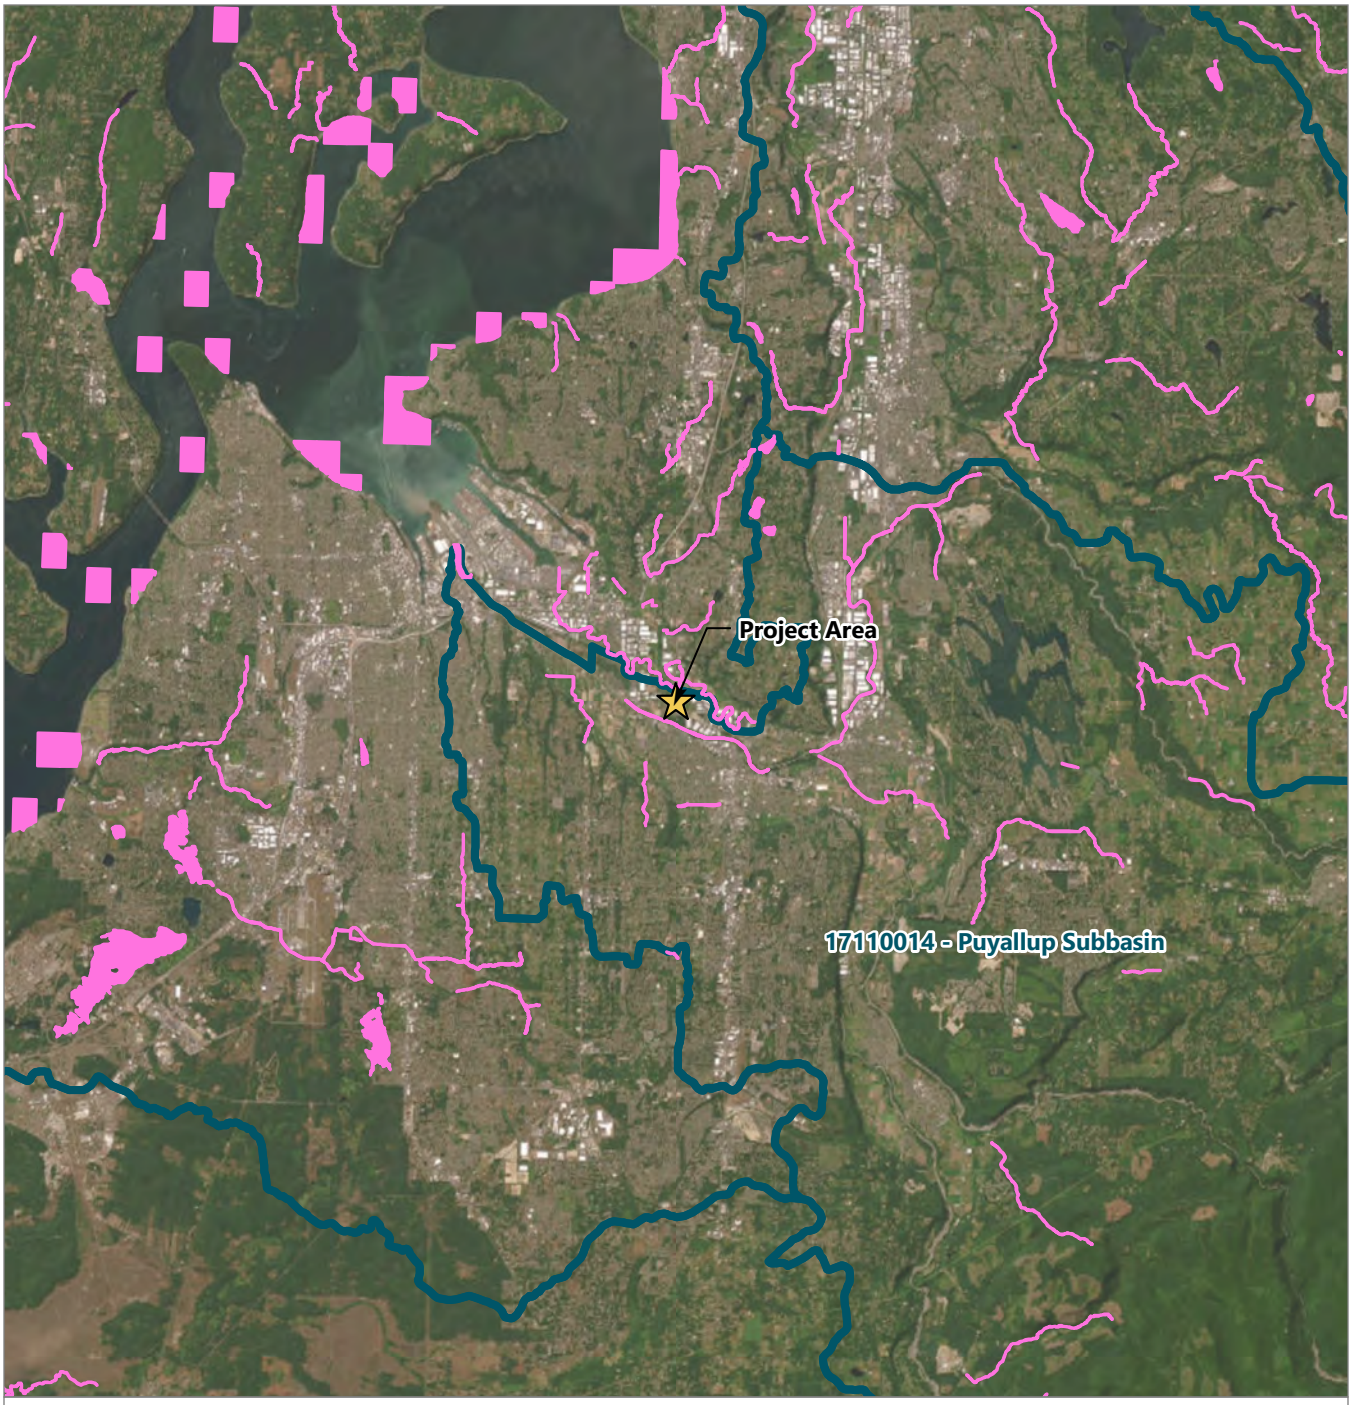

LEGEND:

- Project Area
- 303(d) Listed Water
- HUC8 Watershed


NOTES:
1. Aerial image provided by Esri Online Services.
2. 303(d) lised waters and HUC8 Watershed boundary from Washington State Ecology.

0 4
Miles

Publish Date: 2023/05/25, 10:52 AM | User: alesueur
Filepath: \\orcas\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\Wetlands\Ratings_WetlandB\WetlandB_Ratings.aprx

ANCHOR QEA

Figure 5
303(d) Listed Waters
Wetland Rating Form - Wetland B
Freeman Road Logistics

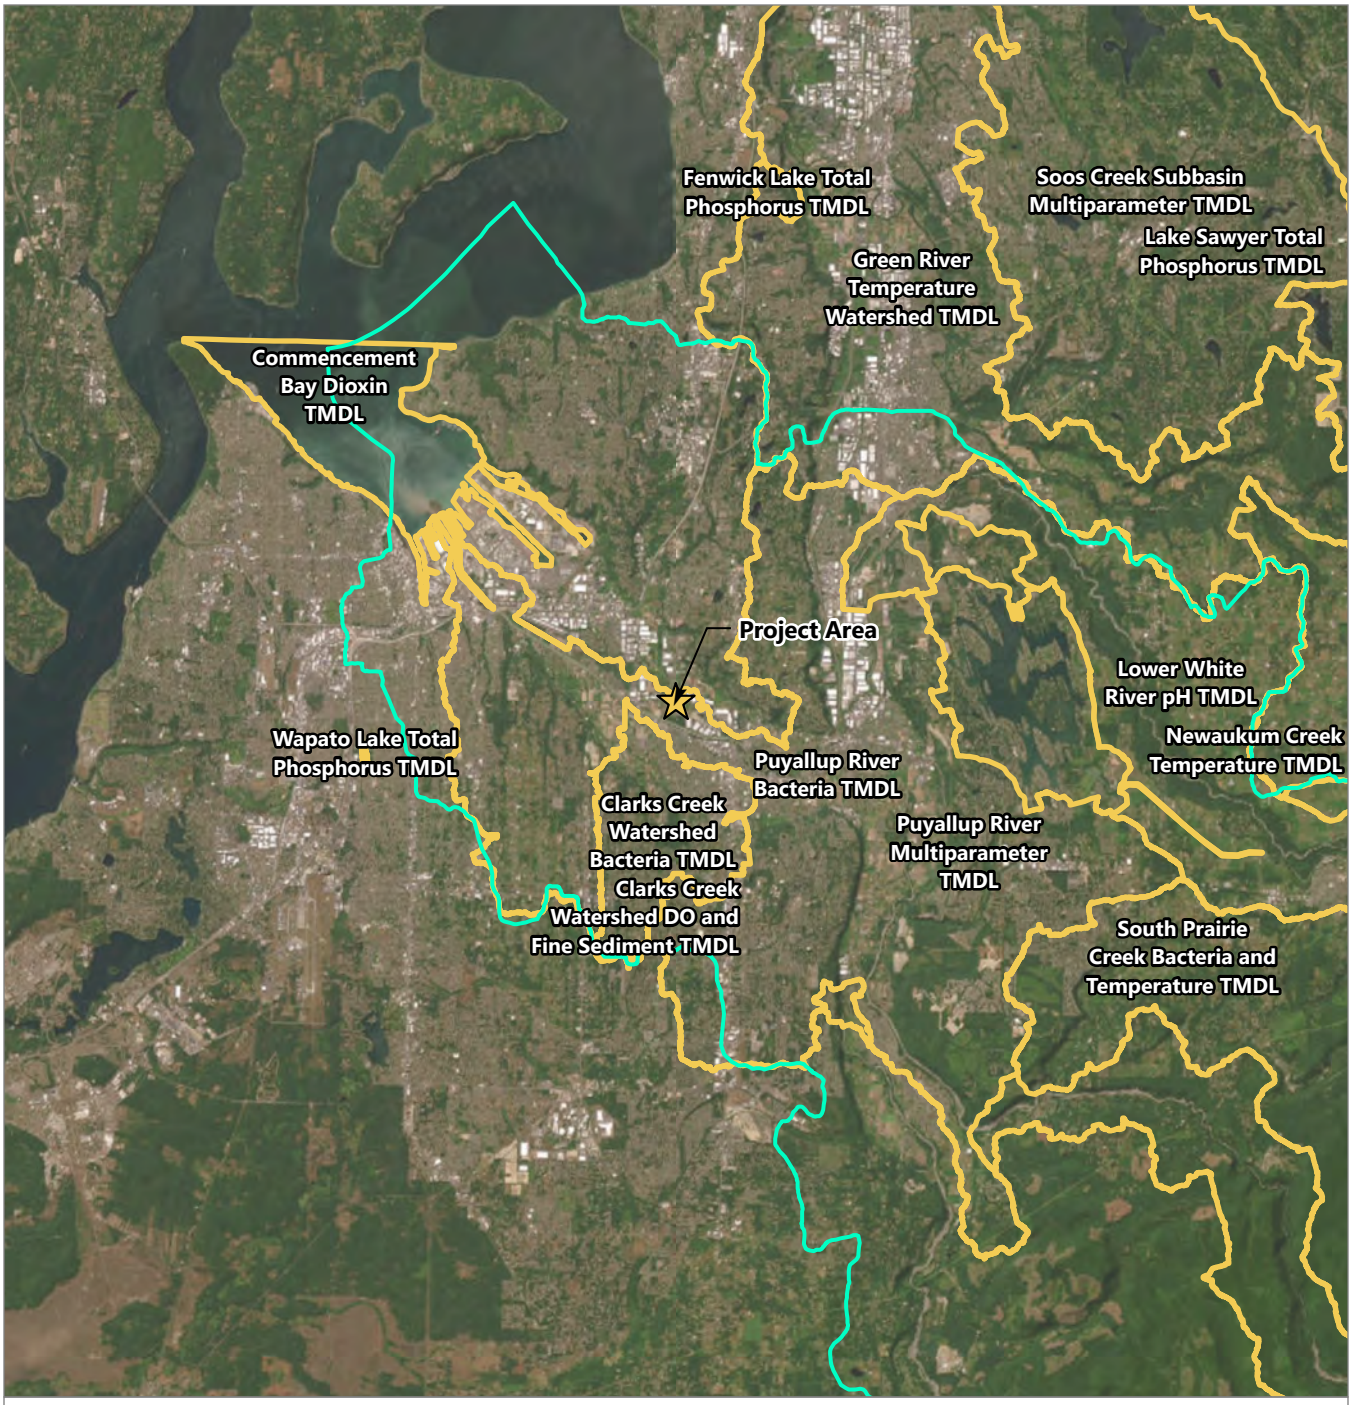

LEGEND:

- Project Area
- WRIA 10 - Puyallup - White
- TMDL

NOTES:
1. Aerial image provided by Esri Online Services.
2. WRIA 10 and TMDL boundaries are from Washington State Ecology.

0 4
Miles

Publish Date: 2023/05/25, 10:51 AM | User: alesueur
Filepath: \\orcas\gis\Jobs\Vector_Development_Company_2141\Freeman_Road\Maps\Wetlands\Ratings_WetlandB\WetlandB_Ratings.aprx

ANCHOR QEA

Figure 6
List of TMDLs for WRIA 10 - Puyallup - White
Wetland Rating Form - Wetland B
Freeman Road Logistics

Appendix C-6
WSDOT Ratings

Wetland name or number: Wetland 87

RATING SUMMARY – Western Washington

Name of wetland (or ID #): SR 167 Completion Project – Wetland 87 Date of site visit: 4/8/2021

Rated by R. Baker Trained by Ecology? ☒ Yes ☐ No Date of Training Sep. 2008

HGM Class used for rating Depressional Wetland has multiple HGM classes? ☐ Yes ☒ No

Additional HGM Classes (*if multiple*): n/a

Source of base aerial photo/map ESRI Aerial, 2020

OVERALL WETLAND CATEGORY III (based on functions ☒ or special characteristics ☐)

1. Category of wetland based on FUNCTIONS

Category III – Total score = 16 – 19

FUNCTION	Improving Water Quality	Hydrologic	Habitat	
Enter the appropriate ratings				
Site Potential	M	M	M	
Landscape Potential	M	M	L	
Value	H	M	H	**TOTAL**
Score Based on Ratings	7			

Score for each function based on three ratings
(*order of ratings is not important*)
9 = H,H,H
8 = H,H,M
7 = H,H,L
7 = H,M,M
6 = H,M,L
6 = M,M,M
5 = H,L,L
5 = M,M,L
4 = M,L,L
3 = L,L,L

2. Category based on SPECIAL CHARACTERISTICS of wetland

CHARACTERISTIC	CATEGORY
Estuarine	
Wetland of High Conservation Value	
Bog	
Mature Forest	
Old Growth Forest	
Coastal Lagoon	
Interdunal	
None of the above	**X**

Maps and figures required to answer questions correctly for Western Washington

Depressional Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	D 1.3, H 1.1, H 1.4	D-23
Hydroperiods and location of outlets	D 1.4, H 1.2, D 1.1, D 4.1	D-24
Flow directions and associated features	n/a	D-24a
Boundary of area within 150 ft of the wetland *(can be added to another figure)*	D 2.2, D 5.2	D-24
Map of the contributing basin	D 4.3, D 5.3	D-25
1 km Polygon: Area that extends 1 km from entire wetland edge—including polygons for accessible habitat and undisturbed habitat	H 2.1, H 2.2, H 2.3	D-26
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	D 3.1, D 3.2	D-5
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	D 3.3	D-6

Wetland name or number: Wetland 87

DEPRESSIONAL AND FLATS WETLANDS

Water Quality Functions – Indicators that the site functions to improve water quality

D 1.0. Does the site have the potential to improve water quality?	
D 1.1. Characteristics of surface water outflows from the wetland: Wetland is a depression or flat depression (QUESTION 7 on key) with no surface water leaving it (no outlet) | points = 3	3
D 1.2. The soil 2 in below the surface (or duff layer) is true clay or true organic *(use NRCS definitions).* No = 0	0
D 1.3. Characteristics and distribution of persistent plants (Emergent, Scrub-shrub, and/or Forested Cowardin classes): Wetland has persistent, ungrazed plants > 95% of area | points = 5	5
D 1.4. Characteristics of seasonal ponding or inundation: *This is the area that is ponded for at least 2 months. See description in manual.* Area seasonally ponded is < 1/4 total area of wetland | points = 0	0
Total for D 1 Add the points in the boxes above (F9 key)	8

Rating of Site Potential If score is: 6–11 = M *Record the rating on the first page*

D 2.0. Does the landscape have the potential to support the water quality function of the site?	
D 2.1. Does the wetland unit receive stormwater discharges? No = 0	0
D 2.2. Is >10% of the area within 150 ft of the wetland in land uses that generate pollutants? Yes = 1	1
D 2.3. Are there septic systems within 250 ft of the wetland? No = 0	0
D 2.4. Are there other sources of pollutants coming into the wetland that are not listed in questions D 2.1–D 2.3? Source: Homeless encampment/trash Yes = 1	1
Total for D 2 Add the points in the boxes above	2

Rating of Landscape Potential If score is: 1 or 2 = M *Record the rating on the first page*

D 3.0. Is the water quality improvement provided by the site valuable to society?	
D 3.1. Does the wetland discharge directly (i.e., within 1 mi) to a stream, river, lake, or marine water that is on the 303(d) list? No = 0	0
D 3.2. Is the wetland in a basin or subbasin where an aquatic resource is on the 303(d) list? Yes = 1	1
D 3.3. Has the site been identified in a watershed or local plan as important for maintaining water quality (*answer YES if there is a TMDL for the basin in which the unit is found*)? Yes = 2	2
Total for D 3 Add the points in the boxes above	3

Rating of Value If score is: 2–4 = H *Record the rating on the first page*

COMMENTS: Area to the North of wetland (across Stream 14) is active conventional agriculture. TMDLs in place for the Puyallup.

Hydrologic Functions – Indicators that the site functions to reduce flooding and stream degradation

D 4.0. Does the site have the potential to reduce flooding and erosion?	
D 4.1. Characteristics of surface water outflows from the wetland: Wetland is a depression or flat depression with no surface water leaving it (no outlet) | points = 4	4
D 4.2. Depth of storage during wet periods: *Estimate the height of ponding above the bottom of the outlet. For wetlands with no outlet, measure from the surface of permanent water or if dry, the deepest part.* Marks of ponding less than 0.5 ft (6 in) | points = 0	0
D 4.3. Contribution of the wetland to storage in the watershed: *Estimate the ratio of the area of upstream basin contributing surface water to the wetland to the area of the wetland unit itself.* The area of the basin is 10 to 100 times the area of the unit | points = 3	3
Total for D 4 Add the points in the boxes above	7

Rating of Site Potential If score is: 6–11 = M *Record the rating on the first page*

D 5.0. Does the landscape have the potential to support hydrologic functions of the site?	
D 5.1. Does the wetland receive stormwater discharges? No = 0	0
D 5.2. Is >10% of the area within 150 ft of the wetland in land uses that generate excess runoff? Yes = 1	1
D 5.3. Is more than 25% of the contributing basin of the wetland covered with intensive human land uses (residential at >1 residence/ac, urban, commercial, agriculture, etc.)? No = 0	0
Total for D 5 Add the points in the boxes above	1

Rating of Landscape Potential If score is: 1 or 2 = M *Record the rating on the first page*

Wetland name or number: Wetland 87

D 6.0. Are the hydrologic functions provided by the site valuable to society?	
D 6.1. The unit is in a landscape that has flooding problems. *Choose the description that best matches conditions around the wetland unit being rated. Do not add points. Choose the highest score if more than one condition is met.* The wetland captures surface water that would otherwise flow down-gradient into areas where flooding has damaged human or natural resources (e.g., houses or salmon redds): Surface flooding problems are in a subbasin farther down-gradient | points = 1 **If not applicable chosen above:** Choose an item. **Explanation for 0 points (if required above):**	1
D 6.2. Has the site been identified as important for flood storage or flood conveyance in a regional flood control plan? No = 0	0
Total for D 6 Add the points in the boxes above	1
Rating of Value If score is: 1 = M *Record the rating on the first page*	
COMMENTS: Wetland is adjacent to conventional ag fields and streams, but not connected to streams via surface flow.	

These questions apply to wetlands of all HGM classes.
HABITAT FUNCTIONS – Indicators that site functions to provide important habitat

H 1.0. Does the site have the potential to provide habitat?		
H 1.1. Structure of plant community: *Indicators are Cowardin classes and strata within the Forested class.* Check the Cowardin plant classes in the wetland. *Up to 10 patches may be combined for each class to meet the threshold of 1/4 ac or more than 10% of the unit if it is smaller than 2.5 ac. Add the number of structures checked.* ☐ Aquatic bed ☐ Emergent ☒ Scrub-shrub (areas where shrubs have >30% cover) ☒ Forested (areas where trees have >30% cover) *If the unit has a Forested class, check if:* ☐ The Forested class has 3 out of 5 strata (canopy, sub-canopy, shrubs, herbaceous, moss/ground-cover) that each cover 20% within the Forested polygon	2 structures | points = 1	1
H 1.2. Hydroperiods Check the types of water regimes (hydroperiods) present within the wetland. The water regime has to cover more than 10% of the wetland or 1/4 ac to count (*see text for descriptions of hydroperiods*). ☐ Permanently flooded or inundated ☒ Seasonally flooded or inundated ☐ Occasionally flooded or inundated ☒ Saturated only ☐ Permanently flowing stream or river in, or adjacent to, the wetland ☐ Seasonally flowing stream in, or adjacent to, the wetland ☐ **Lake Fringe wetland** ☐ **Freshwater tidal wetland**	2 types present | points = 1 **2 points** **2 points**	1
H 1.3. Richness of plant species Count the number of plant species in the wetland that cover at least 10 ft^2. *Different patches of the same species can be combined to meet the size threshold and you do not have to name the species.* ***Do not include Eurasian milfoil, reed canarygrass, purple loosestrife, Canadian thistle.*** If you counted: 5–19 species | points = 1		1

Wetland name or number: Wetland 87

H 1.4. Interspersion of habitats Decide from the diagrams below whether interspersion among Cowardin plants classes (described in H 1.1), or the classes and unvegetated areas (can include open water or mudflats) is high, moderate, low, or none. *If you have four or more plant classes or three classes and open water, the rating is always high.* Choose an item. **None** = 0 points  **Low** = 1 point  **Moderate** = 2 points  All three diagrams in this row are **HIGH** = 3 points 	1
H 1.5. Special habitat features: Check the habitat features that are present in the wetland. *The number of checks is the number of points*. ☒ Large, downed, woody debris within the wetland (>4 in diameter and 6 ft long). ☒ Standing snags (dbh >4 in) within the wetland ☐ Undercut banks are present for at least 6.6 ft (2 m) **and/or** overhanging plants extends at least 3.3 ft (1 m) over a stream (or ditch) in, or contiguous with the wetland, for at least 33 ft (10 m) ☐ Stable steep banks of fine material that might be used by beaver or muskrat for denning (>30 degree slope) OR signs of recent beaver activity are present (*cut shrubs or trees that have not yet weathered where wood is exposed*) ☐ At least 1/4 ac of thin-stemmed persistent plants or woody branches are present in areas that are permanently or seasonally inundated (*structures for egg-laying by amphibians*) ☒ Invasive plants cover less than 25% of the wetland area in every stratum of plants (*see H 1.1 for list of strata*)	3
Total for H 1 Add the points in the boxes above	7

Rating of Site Potential If score is: 7–14 = M *Record the rating on the first page*

H 2.0. Does the landscape have the potential to support the habitat functions of the site?	
H 2.1. Accessible habitat (include *only habitat that directly abuts wetland unit*). *Calculate*: % undisturbed habitat 1.3**+** [(% moderate and low intensity land uses)2.7/2] 1.4 **= 2.7**% If total accessible habitat is: <10% of 1 km Polygon | points = 0	0
H 2.2. Undisturbed habitat in 1 km Polygon around the wetland. *Calculate*: % undisturbed habitat 14.1**+** [(% moderate and low intensity land uses)16.5/2] 8.3 **= 22.4**% Undisturbed habitat 10–50% and >3 patches | points = 1	1
H 2.3. Land use intensity in 1 km Polygon: 69.3**%** >50% of 1 km Polygon is high intensity land use | points = (-2)	-2
Total for H 2 Add the points in the boxes above	-1

Rating of Landscape Potential If score is: < 1 = L *Record the rating on the first page*

Wetland name or number: Wetland 87

H 3.0. Is the habitat provided by the site valuable to society?

H 3.1. Does the site provide habitat for species valued in laws, regulations, or policies? *Choose only the highest score that applies to the wetland being rated.* — 2

WDFW Priority Habitats within 100 m:

☐ Aspen Stands	☐ Biodiversity Areas and Corridors	☐ Herbaceous Balds
☐ Old Growth/Mature Forests	☐ Oregon White Oak	☒ Riparian
☐ Westside Prairies	☒ Instream	☐ Nearshore
☐ Caves	☐ Cliffs	☐ Talus
☒ Snags and Logs		

(*Priority habitats listed by WDFW: For complete descriptions of WDFW priority habitats, and the counties in which they can be found, see: Washington Department of Fish and Wildlife. 2008. Priority Habitat and Species List. Olympia, Washington,* <http://wdfw.wa.gov/publications/00165/wdfw00165.pdf>, *or access the list from here:* <https://wdfw.wa.gov/species-habitats/at-risk/phs/list>.)

Site meets ANY of the following criteria: points = 2

- ☒ It has 3 or more priority habitats within 100 m (checked above)
- ☐ It provides habitat for Threatened or Endangered species (any plant or animal on the state or federal lists)
- ☐ It is mapped as a location for an individual WDFW priority species
- ☐ It is a Wetland of High Conservation Value as determined by the Department of Natural Resources
- ☐ It has been categorized as an important habitat site in a local or regional comprehensive plan, in a Shoreline Master Plan, or in a watershed plan

Site has 1 or 2 priority habitats within 100 m (checked above) points = 1

Site does not meet any of the criteria above points = 0

Rating of Value If score is: 2 = H *Record the rating on the first page*



Legend

Stream

Delineated wetland boundary

Cowardin class

PFO - Palustrine forested

PSS - Palustrine scrub-shrub

Figure D-23.
Cowardin Classes for Wetland 87.


N

0 25 50 100 Feet

HERRERA

ESRI, Aerial (2020)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_CowardinClass_WLX_letter.mxd

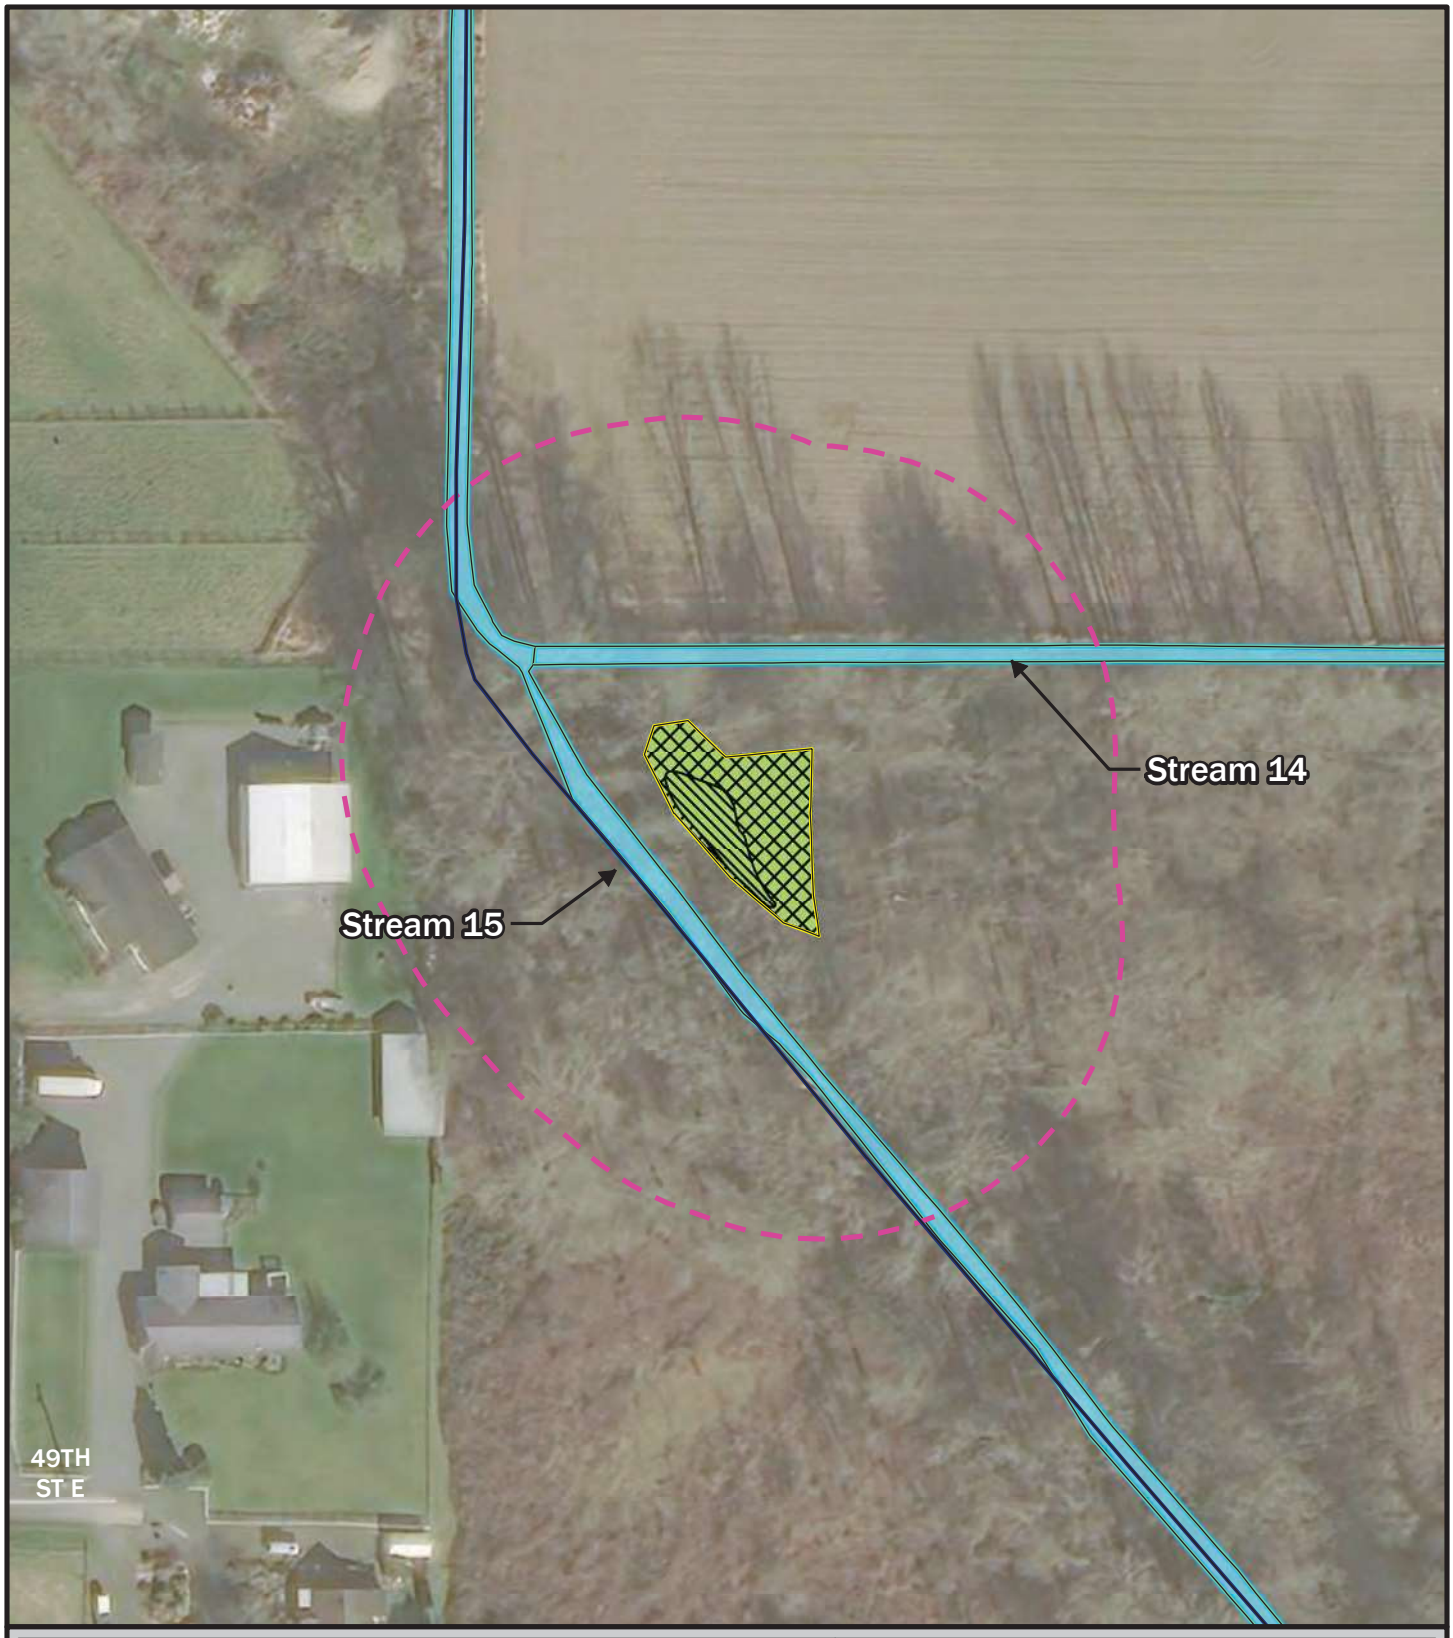

Legend

- Streams (Pierce County 2021)
- Delineated wetland boundary
- Delineated OHWM
- Wetland
- Stream
- 150ft boundary

Hydroperiod

- Saturated only
- Seasonally flooded

Figure D-24.
Hydroperiod, 150-Foot Boundary, and Location of Outlets for Wetland 87.

N

0 45 90 180 Feet

HERRERA

ESRI, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_Hydroperiods_WLX_letter.mxd



Legend

- Flow Direction
- Streams (Pierce County 2021)
- Wetland
- Stream
- Delineated OHWM

Figure D-24a.
Flow Directions and Features Associated with Wetland 87.


N

0 45 90 180 Feet

HERRERA

ESRI, Aerial (2020)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_FlowDirection_WLX_letter.mxd

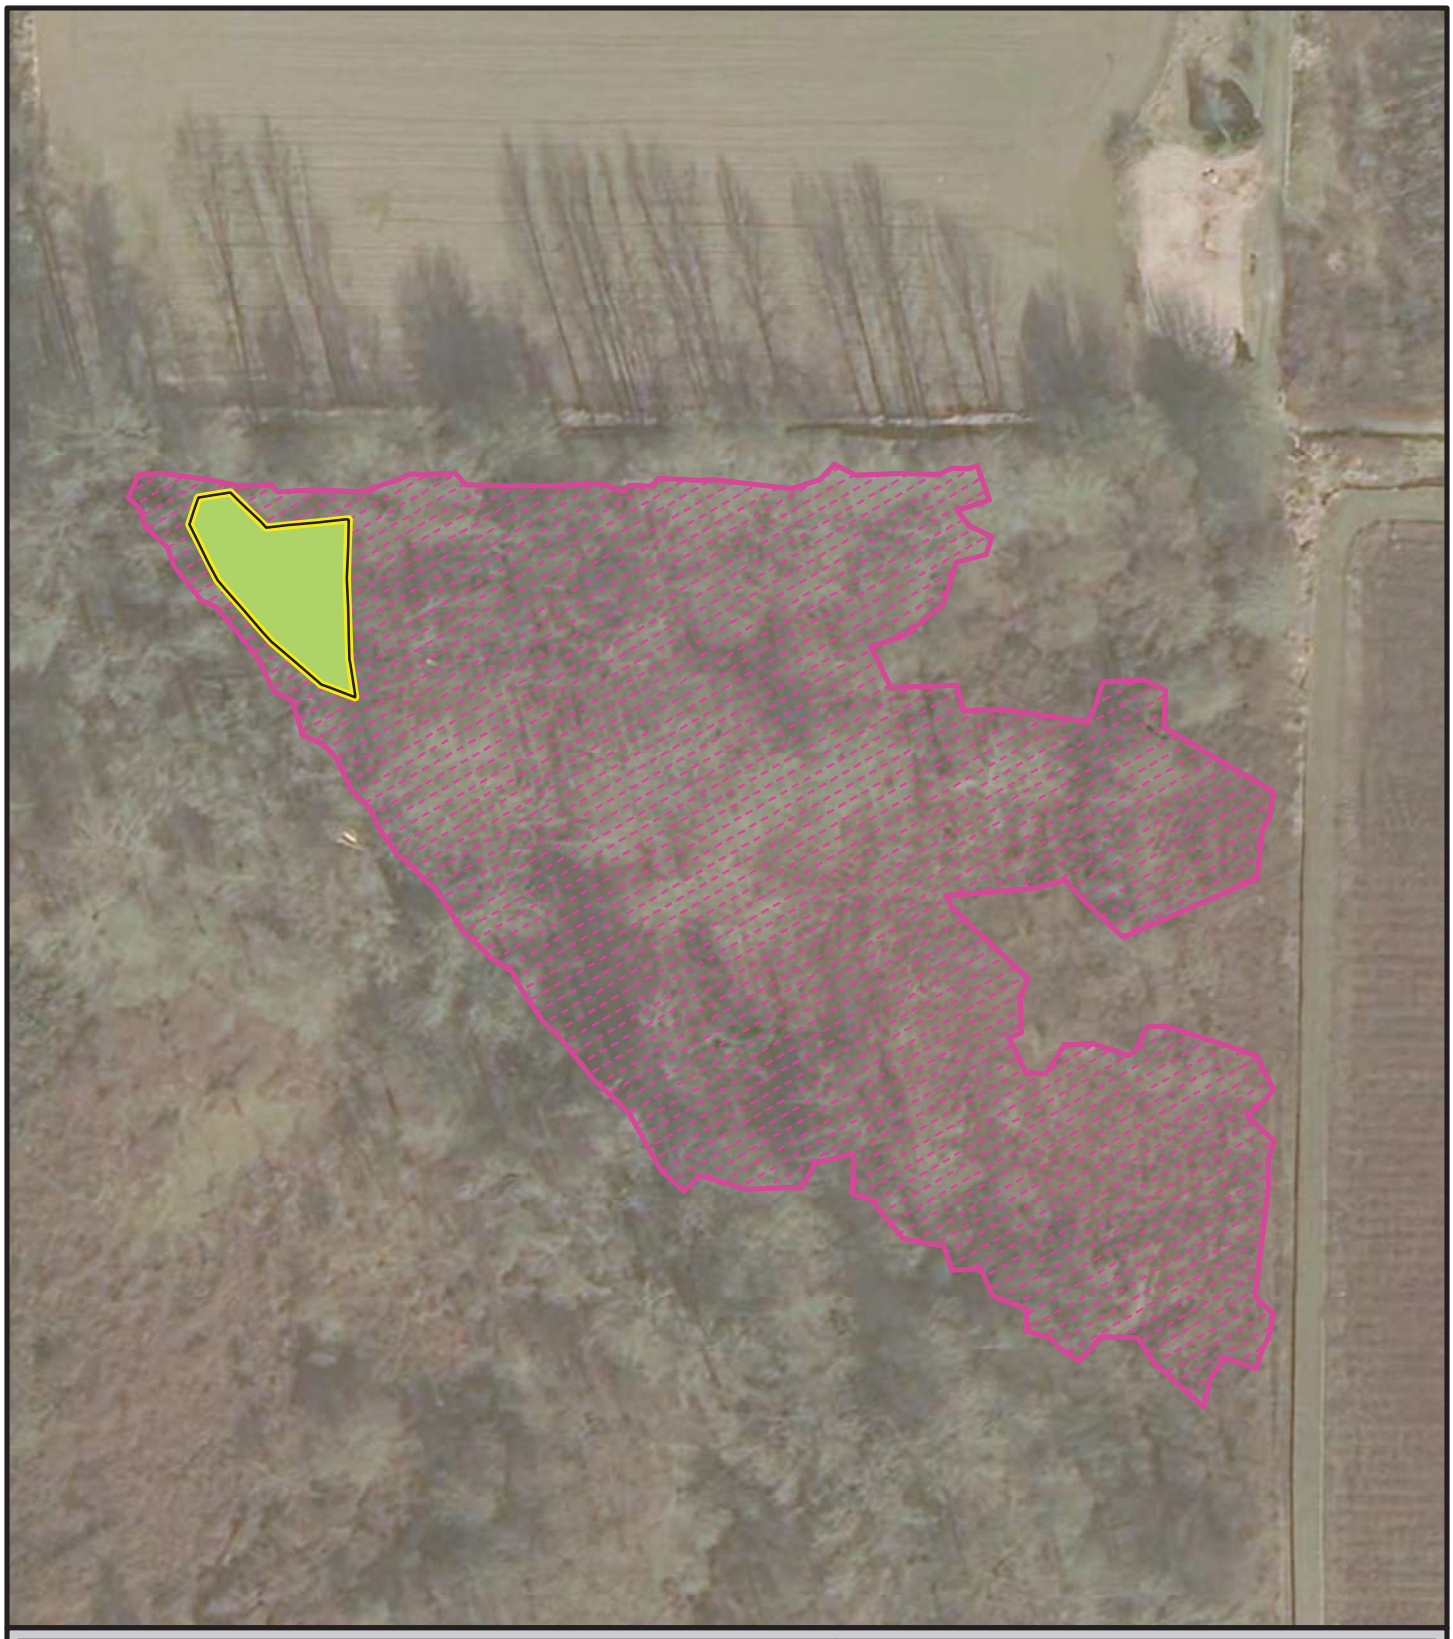

Legend

- Contributing basin
- Wetland
- Delineated wetland boundary

Figure D-25.
Map of Contributing Basin for Wetland 87.


N

0 50 100 200 Feet

HERRERA

Esri, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_ContributingBasin_WLX_letter.mxd

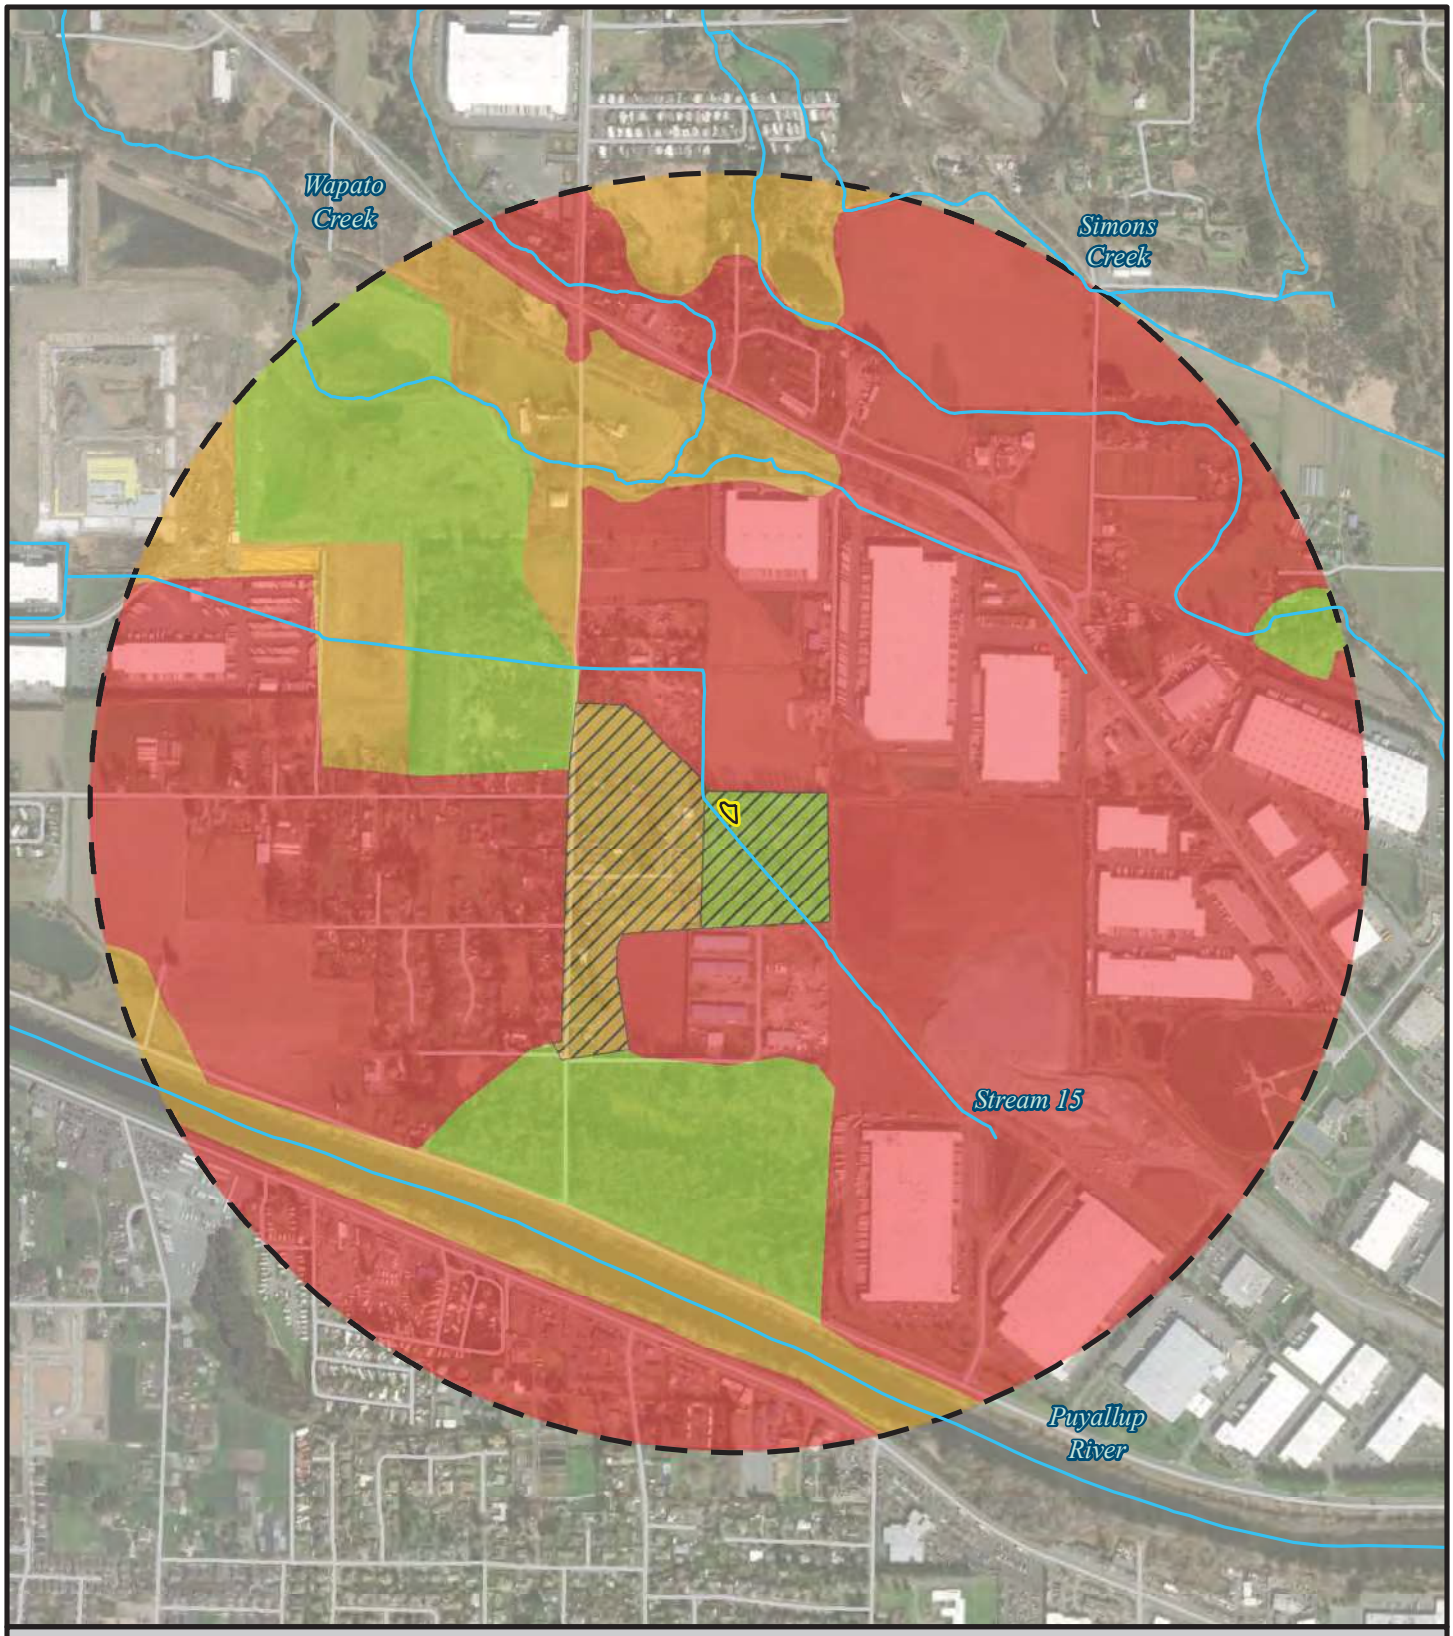

Legend

- Delineated wetland boundary
- 1-km boundary
- Wetland
- Stream (Pierce County)

Habitat type

- High intensity
- Low/Moderate Intensity and accessible
- Low/Moderate Intensity
- Relatively undisturbed
- Relatively undisturbed and accessible

Figure D-26.
Habitat Within a 1-km Boundary of Wetland 87.

N

0 500 1,000 2,000 Feet

HERRERA

Esri, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_Habitat1KM_WLX_letter.mxd

Wetland name or number: Wetland 89

RATING SUMMARY – Western Washington

Name of wetland (or ID #): SR 167 Completion Project – Wetland 89 Date of site visit: 4/8/2021

Rated by R. Baker Trained by Ecology? ☒ Yes ☐ No Date of Training Sep. 2008

HGM Class used for rating Depressional Wetland has multiple HGM classes? ☐ Yes ☒ No

Additional HGM Classes (*if multiple*): n/a

Source of base aerial photo/map ESRI Aerial, 2020

OVERALL WETLAND CATEGORY II (based on functions ☒ or special characteristics ☐)

1. Category of wetland based on FUNCTIONS

Category II – Total score = 20 – 22

FUNCTION	Improving Water Quality	Hydrologic	Habitat	
Enter the appropriate ratings				
Site Potential	M	M	L	
Landscape Potential	H	H	L	
Value	H	M	H	**TOTAL**
Score Based on Ratings	8	7		2

Score for each function based on three ratings

(*order of ratings is not important*)

9 = H,H,H

8 = H,H,M

7 = H,H,L

7 = H,M,M

6 = H,M,L

6 = M,M,M

5 = H,L,L

5 = M,M,L

4 = M,L,L

3 = L,L,L

2. Category based on SPECIAL CHARACTERISTICS of wetland

CHARACTERISTIC	CATEGORY
Estuarine	
Wetland of High Conservation Value	
Bog	
Mature Forest	
Old Growth Forest	
Coastal Lagoon	
Interdunal	
None of the above	**X**

Maps and figures required to answer questions correctly for Western Washington

Depressional Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	D 1.3, H 1.1, H 1.4	D-31
Hydroperiods and location of outlets	D 1.4, H 1.2, D 1.1, D 4.1	D-32
Flow directions and associated features	n/a	D-32a
Boundary of area within 150 ft of the wetland *(can be added to another figure)*	D 2.2, D 5.2	D-32
Map of the contributing basin	D 4.3, D 5.3	D-33
1 km Polygon: Area that extends 1 km from entire wetland edge—including polygons for accessible habitat and undisturbed habitat	H 2.1, H 2.2, H 2.3	D-34
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	D 3.1, D 3.2	D-5
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	D 3.3	D-6

Wetland name or number: Wetland 89

DEPRESSIONAL AND FLATS WETLANDS

Water Quality Functions – Indicators that the site functions to improve water quality

D 1.0. Does the site have the potential to improve water quality?	
D 1.1. Characteristics of surface water outflows from the wetland: Wetland is a depression or flat depression (QUESTION 7 on key) with no surface water leaving it (no outlet) | points = 3	3
D 1.2. The soil 2 in below the surface (or duff layer) is true clay or true organic *(use NRCS definitions).* No = 0	0
D 1.3. Characteristics and distribution of persistent plants (Emergent, Scrub-shrub, and/or Forested Cowardin classes): Wetland has persistent, ungrazed plants > 1/2 of area | points = 3	3
D 1.4. Characteristics of seasonal ponding or inundation: *This is the area that is ponded for at least 2 months. See description in manual.* Area seasonally ponded is < 1/4 total area of wetland | points = 0	0
Total for D 1 Add the points in the boxes above (F9 key)	6

Rating of Site Potential If score is: 6–11 = M *Record the rating on the first page*

D 2.0. Does the landscape have the potential to support the water quality function of the site?	
D 2.1. Does the wetland unit receive stormwater discharges? Yes = 1	1
D 2.2. Is >10% of the area within 150 ft of the wetland in land uses that generate pollutants? Yes = 1	1
D 2.3. Are there septic systems within 250 ft of the wetland? No = 0	0
D 2.4. Are there other sources of pollutants coming into the wetland that are not listed in questions D 2.1–D 2.3? Source: Trash/Homeless encampments Yes = 1	1
Total for D 2 Add the points in the boxes above	3

Rating of Landscape Potential If score is: 3 or 4 = H *Record the rating on the first page*

D 3.0. Is the water quality improvement provided by the site valuable to society?	
D 3.1. Does the wetland discharge directly (i.e., within 1 mi) to a stream, river, lake, or marine water that is on the 303(d) list? No = 0	0
D 3.2. Is the wetland in a basin or subbasin where an aquatic resource is on the 303(d) list? Yes = 1	1
D 3.3. Has the site been identified in a watershed or local plan as important for maintaining water quality (*answer YES if there is a TMDL for the basin in which the unit is found*)? Yes = 2	2
Total for D 3 Add the points in the boxes above	3

Rating of Value If score is: 2–4 = H *Record the rating on the first page*

COMMENTS: Wetland is upstream of the Puyallup River, which has set TMDLs

Hydrologic Functions – Indicators that the site functions to reduce flooding and stream degradation

D 4.0. Does the site have the potential to reduce flooding and erosion?	
D 4.1. Characteristics of surface water outflows from the wetland: Wetland is a depression or flat depression with no surface water leaving it (no outlet) | points = 4	4
D 4.2. Depth of storage during wet periods: *Estimate the height of ponding above the bottom of the outlet. For wetlands with no outlet, measure from the surface of permanent water or if dry, the deepest part.* Marks of ponding less than 0.5 ft (6 in) | points = 0	0
D 4.3. Contribution of the wetland to storage in the watershed: *Estimate the ratio of the area of upstream basin contributing surface water to the wetland to the area of the wetland unit itself.* The area of the basin is less than 10 times the area of the unit | points = 5	5
Total for D 4 Add the points in the boxes above	9

Rating of Site Potential If score is: 6–11 = M *Record the rating on the first page*

D 5.0. Does the landscape have the potential to support hydrologic functions of the site?	
D 5.1. Does the wetland receive stormwater discharges? Yes = 1	1
D 5.2. Is >10% of the area within 150 ft of the wetland in land uses that generate excess runoff? Yes = 1	1
D 5.3. Is more than 25% of the contributing basin of the wetland covered with intensive human land uses (residential at >1 residence/ac, urban, commercial, agriculture, etc.)? Yes = 1	1
Total for D 5 Add the points in the boxes above	3

Rating of Landscape Potential If score is: 3 = H *Record the rating on the first page*

Wetland name or number: Wetland 89

D 6.0. Are the hydrologic functions provided by the site valuable to society?	
D 6.1. The unit is in a landscape that has flooding problems. *Choose the description that best matches conditions around the wetland unit being rated. Do not add points. Choose the highest score if more than one condition is met.* The wetland captures surface water that would otherwise flow down-gradient into areas where flooding has damaged human or natural resources (e.g., houses or salmon redds): Surface flooding problems are in a subbasin farther down-gradient | points = 1 **If not applicable chosen above:** Choose an item. **Explanation for 0 points (if required above):**	1
D 6.2. Has the site been identified as important for flood storage or flood conveyance in a regional flood control plan? No = 0	0
Total for D 6 Add the points in the boxes above	1

Rating of Value If score is: 1 = M *Record the rating on the first page*

COMMENTS:

These questions apply to wetlands of all HGM classes.

HABITAT FUNCTIONS – Indicators that site functions to provide important habitat

H 1.0. Does the site have the potential to provide habitat?		
H 1.1. Structure of plant community: *Indicators are Cowardin classes and strata within the Forested class.* Check the Cowardin plant classes in the wetland. *Up to 10 patches may be combined for each class to meet the threshold of 1/4 ac or more than 10% of the unit if it is smaller than 2.5 ac. Add the number of structures checked.* ☐ Aquatic bed ☐ Emergent ☒ Scrub-shrub (areas where shrubs have >30% cover) ☐ Forested (areas where trees have >30% cover) *If the unit has a Forested class, check if:* ☐ The Forested class has 3 out of 5 strata (canopy, sub-canopy, shrubs, herbaceous, moss/ground-cover) that each cover 20% within the Forested polygon	1 structure | points = 0	0
H 1.2. Hydroperiods Check the types of water regimes (hydroperiods) present within the wetland. The water regime has to cover more than 10% of the wetland or 1/4 ac to count (*see text for descriptions of hydroperiods*). ☐ Permanently flooded or inundated ☐ Seasonally flooded or inundated ☐ Occasionally flooded or inundated ☒ Saturated only ☐ Permanently flowing stream or river in, or adjacent to, the wetland ☐ Seasonally flowing stream in, or adjacent to, the wetland ☐ **Lake Fringe wetland** ☐ **Freshwater tidal wetland**	1 type present | points = 0 **2 points** **2 points**	0
H 1.3. Richness of plant species Count the number of plant species in the wetland that cover at least 10 ft^2. *Different patches of the same species can be combined to meet the size threshold and you do not have to name the species.* ***Do not include Eurasian milfoil, reed canarygrass, purple loosestrife, Canadian thistle.*** If you counted: <5 species | points = 0		0

Wetland name or number: Wetland 89

H 1.4. Interspersion of habitats Decide from the diagrams below whether interspersion among Cowardin plants classes (described in H 1.1), or the classes and unvegetated areas (can include open water or mudflats) is high, moderate, low, or none. *If you have four or more plant classes or three classes and open water, the rating is always high.* None | points = 0 **None** = 0 points  **Low** = 1 point  **Moderate** = 2 points  All three diagrams in this row are **HIGH** = 3 points 	0
H 1.5. Special habitat features: Check the habitat features that are present in the wetland. *The number of checks is the number of points*. ☐ Large, downed, woody debris within the wetland (>4 in diameter and 6 ft long). ☐ Standing snags (dbh >4 in) within the wetland ☐ Undercut banks are present for at least 6.6 ft (2 m) **and/or** overhanging plants extends at least 3.3 ft (1 m) over a stream (or ditch) in, or contiguous with the wetland, for at least 33 ft (10 m) ☐ Stable steep banks of fine material that might be used by beaver or muskrat for denning (>30 degree slope) OR signs of recent beaver activity are present (*cut shrubs or trees that have not yet weathered where wood is exposed*) ☐ At least 1/4 ac of thin-stemmed persistent plants or woody branches are present in areas that are permanently or seasonally inundated (*structures for egg-laying by amphibians*) ☐ Invasive plants cover less than 25% of the wetland area in every stratum of plants (*see H 1.1 for list of strata*)	0
Total for H 1 Add the points in the boxes above	0

Rating of Site Potential If score is: 0–6 = L *Record the rating on the first page*

H 2.0. Does the landscape have the potential to support the habitat functions of the site?	
H 2.1. Accessible habitat (include *only habitat that directly abuts wetland unit*). *Calculate*: % undisturbed habitat 1.3**+** [(% moderate and low intensity land uses)2.7/2] 1.4 **= 2.7**% If total accessible habitat is: <10% of 1 km Polygon | points = 0	0
H 2.2. Undisturbed habitat in 1 km Polygon around the wetland. *Calculate*: % undisturbed habitat 11.9**+** [(% moderate and low intensity land uses)14.1/2] 7.1 **= 19.0**% Undisturbed habitat 10–50% and >3 patches | points = 1	1
H 2.3. Land use intensity in 1 km Polygon: 73.9% >50% of 1 km Polygon is high intensity land use | points = (-2)	-2
Total for H 2 Add the points in the boxes above	-1

Rating of Landscape Potential If score is: < 1 = L *Record the rating on the first page*

Wetland name or number: Wetland 89

H 3.0. Is the habitat provided by the site valuable to society?

H 3.1. Does the site provide habitat for species valued in laws, regulations, or policies? *Choose only the highest score that applies to the wetland being rated.* — 2

WDFW Priority Habitats within 100 m:

☐ Aspen Stands	☐ Biodiversity Areas and Corridors	☐ Herbaceous Balds
☐ Old Growth/Mature Forests	☐ Oregon White Oak	☒ Riparian
☐ Westside Prairies	☒ Instream	☐ Nearshore
☐ Caves	☐ Cliffs	☐ Talus
☒ Snags and Logs		

(*Priority habitats listed by WDFW: For complete descriptions of WDFW priority habitats, and the counties in which they can be found, see: Washington Department of Fish and Wildlife. 2008. Priority Habitat and Species List. Olympia, Washington,* <http://wdfw.wa.gov/publications/00165/wdfw00165.pdf>, *or access the list from here:* <https://wdfw.wa.gov/species-habitats/at-risk/phs/list>.)

Site meets ANY of the following criteria: points = 2

- ☒ It has 3 or more priority habitats within 100 m (checked above)
- ☐ It provides habitat for Threatened or Endangered species (any plant or animal on the state or federal lists)
- ☐ It is mapped as a location for an individual WDFW priority species
- ☐ It is a Wetland of High Conservation Value as determined by the Department of Natural Resources
- ☐ It has been categorized as an important habitat site in a local or regional comprehensive plan, in a Shoreline Master Plan, or in a watershed plan

Site has 1 or 2 priority habitats within 100 m (checked above) points = 1

Site does not meet any of the criteria above points = 0

Rating of Value If score is: 2 = H *Record the rating on the first page*



Legend

Stream

Delineated wetland boundary

Cowardin class

PSS - Palustrine scrub-shrub

Figure D-31.
Cowardin Classes for Wetland 89.

N

0 25 50 100 Feet

HERRERA

ESRI, Aerial (2020)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_CowardinClass_WLX_letter.mxd



Legend

- Streams (Pierce County 2021)
- Delineated wetland boundary
- Delineated OHWM
- Wetland
- Stream
- 150ft boundary
- Hydroperiod
- Saturated only

Figure D-32.
Hydroperiod, 150-Foot Boundary, and Location of Outlets for Wetland 89.

N

0 45 90 180 Feet

HERRERA

ESRI, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_Hydroperiods_WLX_letter.mxd



Legend

- Flow Direction
- Streams (Pierce County 2021)
- Surveyed ditches
- Culverts
- Wetland
- Stream
- Delineated OHWM

Figure D-32a.
Flow Directions and Features Associated with Wetland 89.

N

0 45 90 180 Feet

HERRERA

ESRI, Aerial (2020)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_FlowDirection_WLX_letter.mxd



Legend

- Contributing basin
- Wetland
- Delineated wetland boundary

Figure D-33.
Map of Contributing Basin for Wetland 89.


N

0 50 100 200 Feet

HERRERA

Esri, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_ContributingBasin_WLX_letter.mxd

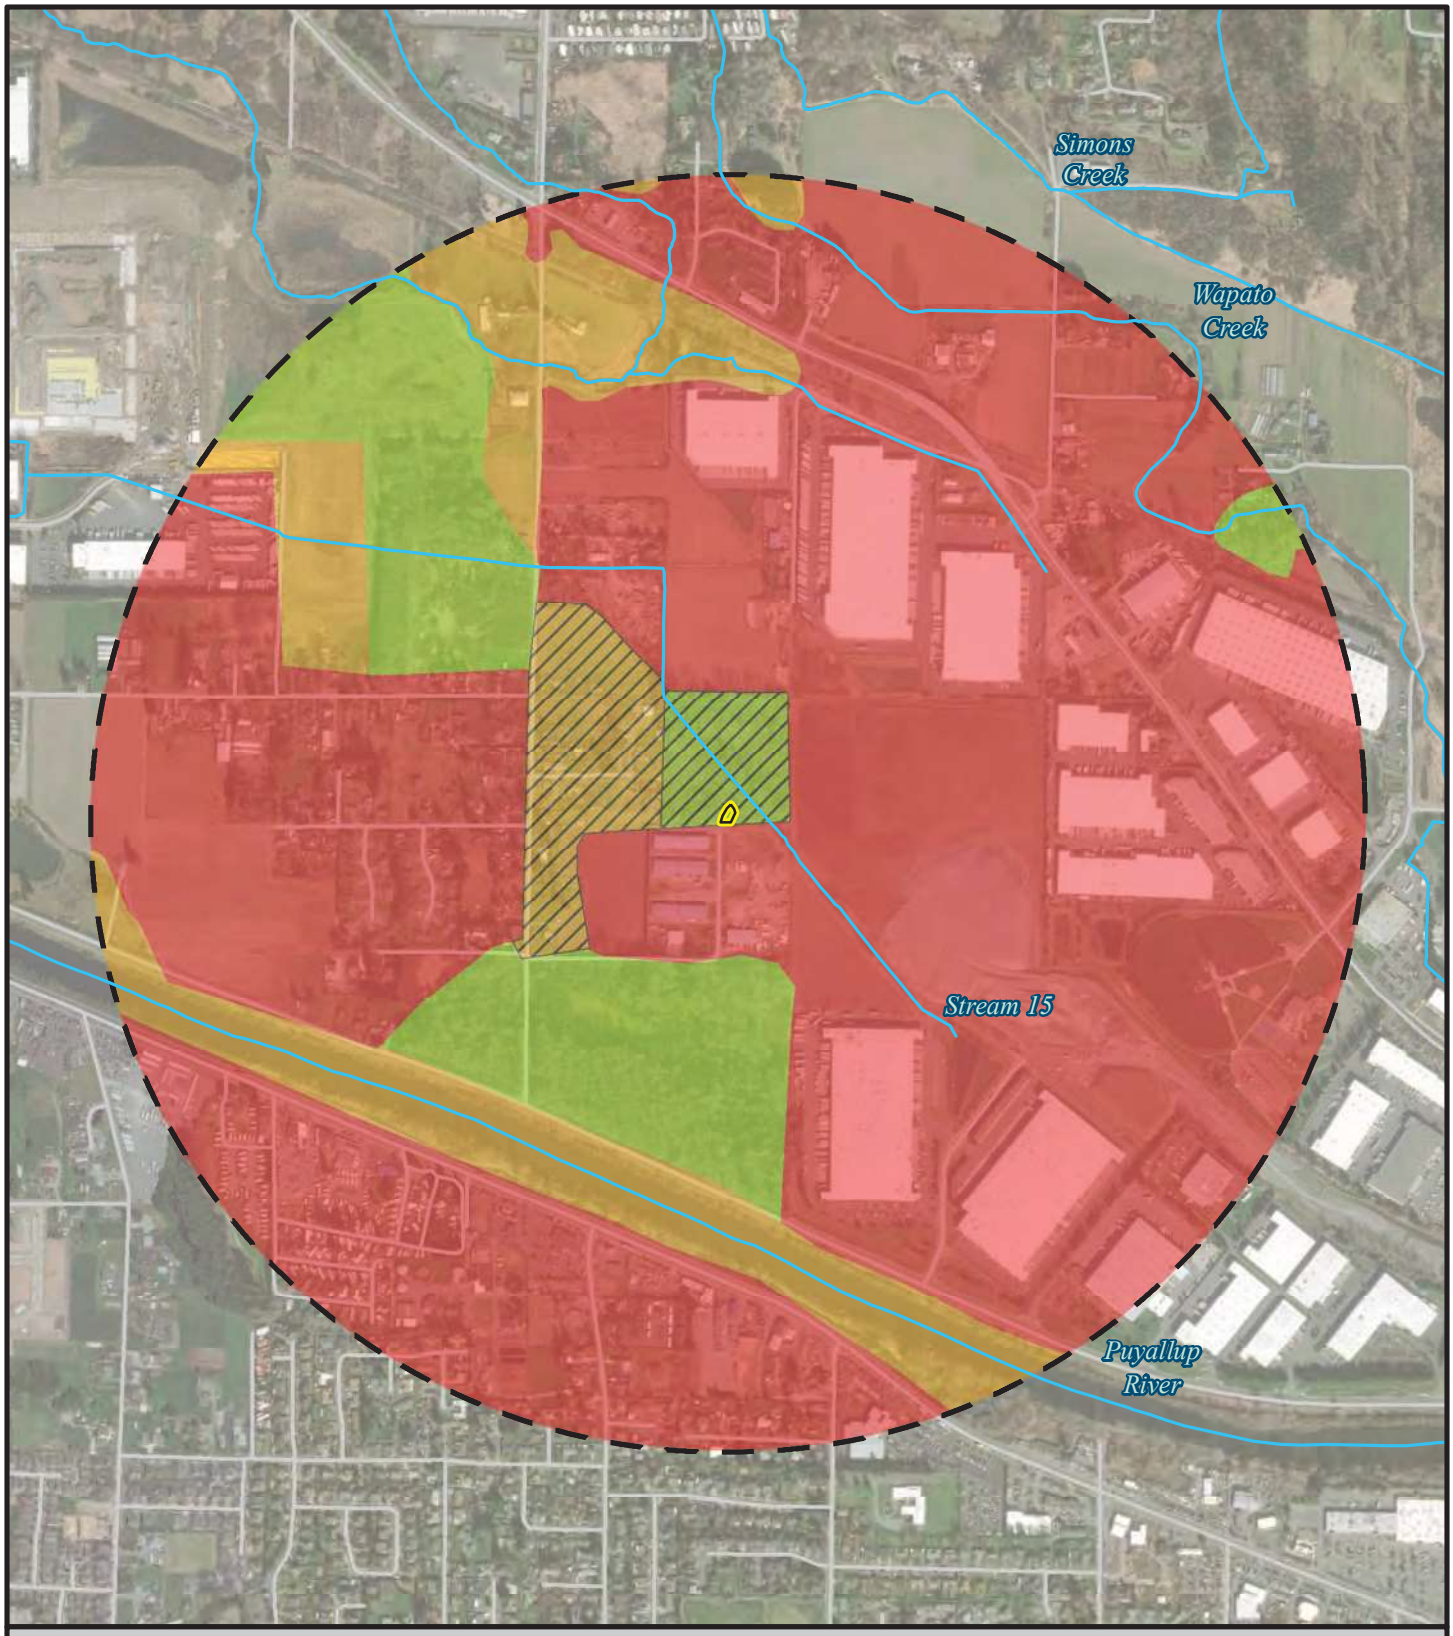

Legend

- Delineated wetland boundary
- 1-km boundary
- Wetland
- Stream (Pierce County)

Habitat type

- High intensity
- Low/Moderate Intensity and accessible
- Low/Moderate Intensity
- Relatively undisturbed
- Relatively undisturbed and accessible

Figure D-34.
Habitat Within a 1-km Boundary of Wetland 89.

N

0 500 1,000 2,000 Feet

HERRERA

Esri, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_Habitat1KM_WLX_letter.mxd

Wetland name or number: Wetland 93

RATING SUMMARY – Western Washington

Name of wetland (or ID #): SR 167 Completion Project – Wetland 93 Date of site visit: 4/20/2021

Rated by R. Baker Trained by Ecology? ☒ Yes ☐ No Date of Training Sep. 2008

HGM Class used for rating Depressional Wetland has multiple HGM classes? ☐ Yes ☒ No

Additional HGM Classes (*if multiple*): n/a

Source of base aerial photo/map ESRI Aerial, 2020

OVERALL WETLAND CATEGORY III (based on functions ☒ or special characteristics ☐)

1. Category of wetland based on FUNCTIONS

Category III – Total score = 16 – 19

FUNCTION	Improving Water Quality	Hydrologic	Habitat	
Enter the appropriate ratings				
Site Potential	L	M	L	
Landscape Potential	H	H	L	
Value	H	M	M	**TOTAL**
Score Based on Ratings	7	7		8

Score for each function based on three ratings

(*order of ratings is not important*)

9 = H,H,H

8 = H,H,M

7 = H,H,L

7 = H,M,M

6 = H,M,L

6 = M,M,M

5 = H,L,L

5 = M,M,L

4 = M,L,L

3 = L,L,L

2. Category based on SPECIAL CHARACTERISTICS of wetland

CHARACTERISTIC	CATEGORY
Estuarine	
Wetland of High Conservation Value	
Bog	
Mature Forest	
Old Growth Forest	
Coastal Lagoon	
Interdunal	
None of the above	**X**

Maps and figures required to answer questions correctly for Western Washington

Depressional Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	D 1.3, H 1.1, H 1.4	D-39
Hydroperiods and location of outlets	D 1.4, H 1.2, D 1.1, D 4.1	D-40
Flow directions and associated features	n/a	D-40a
Boundary of area within 150 ft of the wetland *(can be added to another figure)*	D 2.2, D 5.2	D-40
Map of the contributing basin	D 4.3, D 5.3	D-41
1 km Polygon: Area that extends 1 km from entire wetland edge—including polygons for accessible habitat and undisturbed habitat	H 2.1, H 2.2, H 2.3	D-42
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	D 3.1, D 3.2	D-5
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	D 3.3	D-6

Wetland name or number: Wetland 93

DEPRESSIONAL AND FLATS WETLANDS

Water Quality Functions – Indicators that the site functions to improve water quality

D 1.0. Does the site have the potential to improve water quality?	
D 1.1. Characteristics of surface water outflows from the wetland: Wetland is a depression or flat depression (QUESTION 7 on key) with no surface water leaving it (no outlet) | points = 3	3
D 1.2. The soil 2 in below the surface (or duff layer) is true clay or true organic *(use NRCS definitions).* No = 0	0
D 1.3. Characteristics and distribution of persistent plants (Emergent, Scrub-shrub, and/or Forested Cowardin classes): Wetland has persistent, ungrazed plants < 1/10 of area | points = 0	0
D 1.4. Characteristics of seasonal ponding or inundation: *This is the area that is ponded for at least 2 months. See description in manual.* Area seasonally ponded is < 1/4 total area of wetland | points = 0	0
Total for D 1 Add the points in the boxes above (F9 key)	3

Rating of Site Potential If score is: 0–5 = L *Record the rating on the first page*

D 2.0. Does the landscape have the potential to support the water quality function of the site?	
D 2.1. Does the wetland unit receive stormwater discharges? Yes = 1	1
D 2.2. Is >10% of the area within 150 ft of the wetland in land uses that generate pollutants? Yes = 1	1
D 2.3. Are there septic systems within 250 ft of the wetland? Yes = 1	1
D 2.4. Are there other sources of pollutants coming into the wetland that are not listed in questions D 2.1–D 2.3? Source: waterfowl droppings Yes = 1	1
Total for D 2 Add the points in the boxes above	4

Rating of Landscape Potential If score is: 3 or 4 = H *Record the rating on the first page*

D 3.0. Is the water quality improvement provided by the site valuable to society?	
D 3.1. Does the wetland discharge directly (i.e., within 1 mi) to a stream, river, lake, or marine water that is on the 303(d) list? No = 0	0
D 3.2. Is the wetland in a basin or subbasin where an aquatic resource is on the 303(d) list? Yes = 1	1
D 3.3. Has the site been identified in a watershed or local plan as important for maintaining water quality (*answer YES if there is a TMDL for the basin in which the unit is found*)? Yes = 2	2
Total for D 3 Add the points in the boxes above	3

Rating of Value If score is: 2–4 = H *Record the rating on the first page*

COMMENTS: Wetland is adjacent to Stream 14, but does not have direct connection. Pierce County indicates homes on septic in area of wetland. Wetland is upstream of Puyallup, which has TMDLs in place.

Hydrologic Functions – Indicators that the site functions to reduce flooding and stream degradation

D 4.0. Does the site have the potential to reduce flooding and erosion?	
D 4.1. Characteristics of surface water outflows from the wetland: Wetland is a depression or flat depression with no surface water leaving it (no outlet) | points = 4	4
D 4.2. Depth of storage during wet periods: *Estimate the height of ponding above the bottom of the outlet. For wetlands with no outlet, measure from the surface of permanent water or if dry, the deepest part.* Marks of ponding less than 0.5 ft (6 in) | points = 0	0
D 4.3. Contribution of the wetland to storage in the watershed: *Estimate the ratio of the area of upstream basin contributing surface water to the wetland to the area of the wetland unit itself.* The area of the basin is less than 10 times the area of the unit | points = 5	5
Total for D 4 Add the points in the boxes above	9

Rating of Site Potential If score is: 6–11 = M *Record the rating on the first page*

Wetland name or number: Wetland 93

D 5.0. Does the landscape have the potential to support hydrologic functions of the site?		
D 5.1. Does the wetland receive stormwater discharges?	Yes = 1	1
D 5.2. Is >10% of the area within 150 ft of the wetland in land uses that generate excess runoff?	Yes = 1	1
D 5.3. Is more than 25% of the contributing basin of the wetland covered with intensive human land uses (residential at >1 residence/ac, urban, commercial, agriculture, etc.)?	Yes = 1	1
Total for D 5	Add the points in the boxes above	3

Rating of Landscape Potential If score is: 3 = H *Record the rating on the first page*

D 6.0. Are the hydrologic functions provided by the site valuable to society?		
D 6.1. The unit is in a landscape that has flooding problems. *Choose the description that best matches conditions around the wetland unit being rated. Do not add points. Choose the highest score if more than one condition is met.* The wetland captures surface water that would otherwise flow down-gradient into areas where flooding has damaged human or natural resources (e.g., houses or salmon redds): Surface flooding problems are in a subbasin farther down-gradient | points = 1 **If not applicable chosen above:** Choose an item. **Explanation for 0 points (if required above):**		1
D 6.2. Has the site been identified as important for flood storage or flood conveyance in a regional flood control plan?	No = 0	0
Total for D 6	Add the points in the boxes above	1

Rating of Value If score is: 1 = M *Record the rating on the first page*

COMMENTS:

These questions apply to wetlands of all HGM classes.

HABITAT FUNCTIONS – Indicators that site functions to provide important habitat

H 1.0. Does the site have the potential to provide habitat?		
H 1.1. Structure of plant community: *Indicators are Cowardin classes and strata within the Forested class.* Check the Cowardin plant classes in the wetland. *Up to 10 patches may be combined for each class to meet the threshold of 1/4 ac or more than 10% of the unit if it is smaller than 2.5 ac. Add the number of structures checked.* ☐ Aquatic bed ☒ Emergent ☐ Scrub-shrub (areas where shrubs have >30% cover) ☐ Forested (areas where trees have >30% cover) *If the unit has a Forested class, check if:* ☐ The Forested class has 3 out of 5 strata (canopy, sub-canopy, shrubs, herbaceous, moss/ground-cover) that each cover 20% within the Forested polygon	1 structure | points = 0	0
H 1.2. Hydroperiods Check the types of water regimes (hydroperiods) present within the wetland. The water regime has to cover more than 10% of the wetland or 1/4 ac to count (*see text for descriptions of hydroperiods*). ☐ Permanently flooded or inundated ☒ Seasonally flooded or inundated ☐ Occasionally flooded or inundated ☒ Saturated only ☐ Permanently flowing stream or river in, or adjacent to, the wetland ☐ Seasonally flowing stream in, or adjacent to, the wetland ☐ **Lake Fringe wetland** ☐ **Freshwater tidal wetland**	2 types present | points = 1 **2 points** **2 points**	1

Wetland name or number: Wetland 93

H 1.3. Richness of plant species Count the number of plant species in the wetland that cover at least 10 ft^2. *Different patches of the same species can be combined to meet the size threshold and you do not have to name the species*. ***Do not include Eurasian milfoil, reed canarygrass, purple loosestrife, Canadian thistle.*** If you counted: 5–19 species | points = 1	1
H 1.4. Interspersion of habitats Decide from the diagrams below whether interspersion among Cowardin plants classes (described in H 1.1), or the classes and unvegetated areas (can include open water or mudflats) is high, moderate, low, or none. *If you have four or more plant classes or three classes and open water, the rating is always high.* None | points = 0 **None** = 0 points  **Low** = 1 point  **Moderate** = 2 points  All three diagrams in this row are **HIGH** = 3 points 	0
H 1.5. Special habitat features: Check the habitat features that are present in the wetland. *The number of checks is the number of points*. ☐ Large, downed, woody debris within the wetland (>4 in diameter and 6 ft long). ☐ Standing snags (dbh >4 in) within the wetland ☐ Undercut banks are present for at least 6.6 ft (2 m) **and/or** overhanging plants extends at least 3.3 ft (1 m) over a stream (or ditch) in, or contiguous with the wetland, for at least 33 ft (10 m) ☐ Stable steep banks of fine material that might be used by beaver or muskrat for denning (>30 degree slope) OR signs of recent beaver activity are present (*cut shrubs or trees that have not yet weathered where wood is exposed*) ☐ At least 1/4 ac of thin-stemmed persistent plants or woody branches are present in areas that are permanently or seasonally inundated (*structures for egg-laying by amphibians*) ☒ Invasive plants cover less than 25% of the wetland area in every stratum of plants (*see H 1.1 for list of strata*)	1
Total for H 1 Add the points in the boxes above	3

Rating of Site Potential If score is: 0–6 = L *Record the rating on the first page*

H 2.0. Does the landscape have the potential to support the habitat functions of the site?	
H 2.1. Accessible habitat (include *only habitat that directly abuts wetland unit*). *Calculate*: % undisturbed habitat 1.1**+** [(% moderate and low intensity land uses)2.3/2] 1.2 **= 2.3**% If total accessible habitat is: <10% of 1 km Polygon | points = 0	0
H 2.2. Undisturbed habitat in 1 km Polygon around the wetland. *Calculate*: % undisturbed habitat 14.4**+** [(% moderate and low intensity land uses)18.1/2] 9.1 **= 23.5**% Undisturbed habitat 10–50% and >3 patches | points = 1	1
H 2.3. Land use intensity in 1 km Polygon: 67.5% >50% of 1 km Polygon is high intensity land use | points = (-2)	-2
Total for H 2 Add the points in the boxes above	-1

Rating of Landscape Potential If score is: < 1 = L *Record the rating on the first page*

Wetland name or number: Wetland 93

H 3.0. Is the habitat provided by the site valuable to society?

H 3.1. Does the site provide habitat for species valued in laws, regulations, or policies? *Choose only the highest score that applies to the wetland being rated.* 1

WDFW Priority Habitats within 100 m:

☐ Aspen Stands	☐ Biodiversity Areas and Corridors	☐ Herbaceous Balds
☐ Old Growth/Mature Forests	☐ Oregon White Oak	☒ Riparian
☐ Westside Prairies	☒ Instream	☐ Nearshore
☐ Caves	☐ Cliffs	☐ Talus
☐ Snags and Logs		

(*Priority habitats listed by WDFW: For complete descriptions of WDFW priority habitats, and the counties in which they can be found, see: Washington Department of Fish and Wildlife. 2008. Priority Habitat and Species List. Olympia, Washington,* <http://wdfw.wa.gov/publications/00165/wdfw00165.pdf>, *or access the list from here:* <https://wdfw.wa.gov/species-habitats/at-risk/phs/list>.)

Site meets ANY of the following criteria: points = 2

- ☐ It has 3 or more priority habitats within 100 m (checked above)
- ☐ It provides habitat for Threatened or Endangered species (any plant or animal on the state or federal lists)
- ☐ It is mapped as a location for an individual WDFW priority species
- ☐ It is a Wetland of High Conservation Value as determined by the Department of Natural Resources
- ☐ It has been categorized as an important habitat site in a local or regional comprehensive plan, in a Shoreline Master Plan, or in a watershed plan

Site has 1 or 2 priority habitats within 100 m (checked above) points = 1

Site does not meet any of the criteria above points = 0

Rating of Value If score is: 1 = M *Record the rating on the first page*



Legend

Stream

Delineated wetland boundary

Estimated OHWM

Cowardin class

PEM - Palustrine emergent

Figure D-39.
Cowardin Classes for Wetland 93.


N

0 50 100 200 Feet

HERRERA

ESRI, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_CowardinClass_WLX_letter.mxd

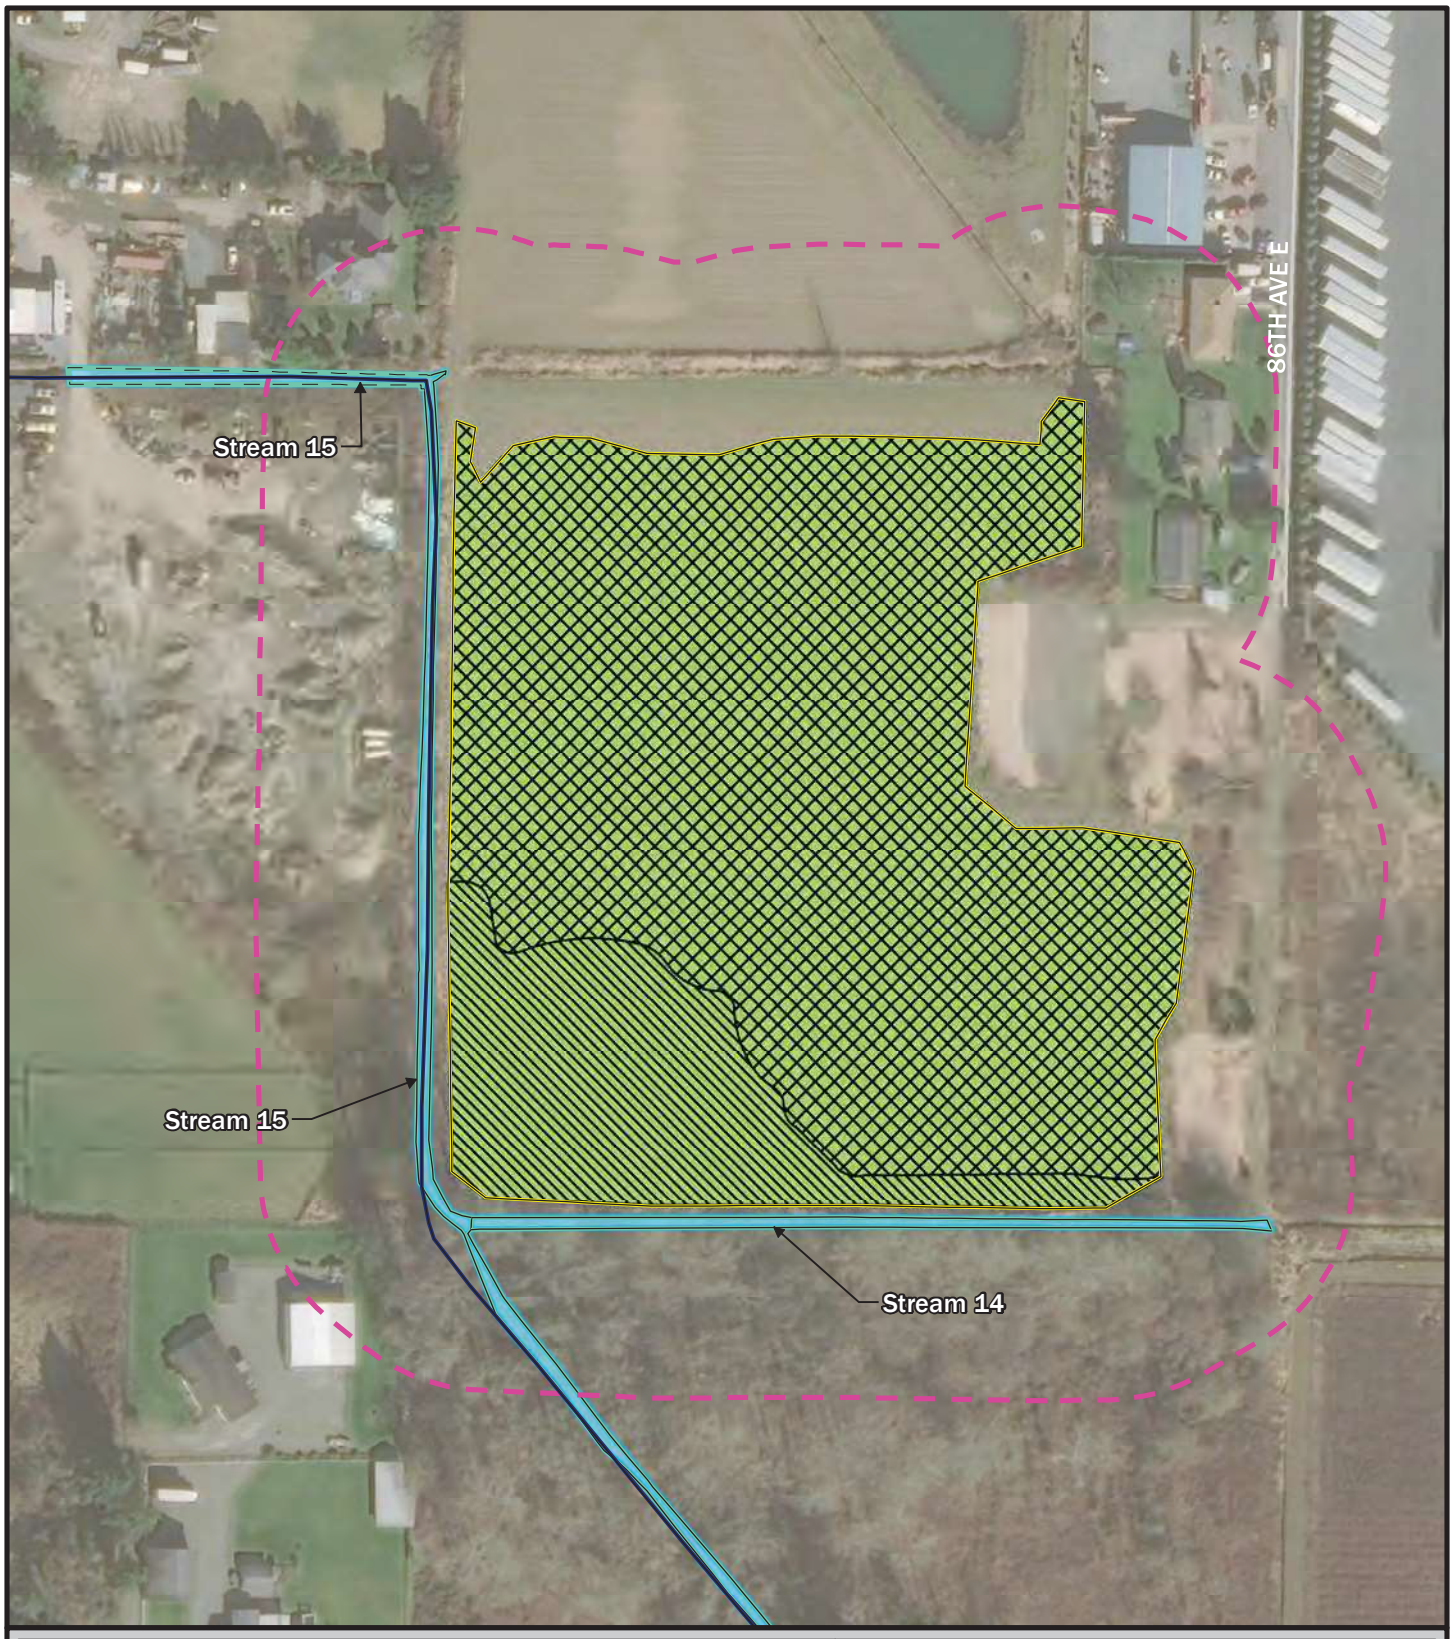

Legend

- Streams (Pierce County 2021)
- Delineated wetland boundary
- Delineated OHWM
- Estimated OHWM
- Wetland
- Stream
- 150ft boundary

Hydroperiod

- Saturated only
- Seasonally flooded

Figure D-40.
Hydroperiod, 150-Foot Boundary, and Location of Outlets for Wetland 93.

N

0 75 150 300 Feet

HERRERA

ESRI, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_Hydroperiods_WLX_letter.mxd



Legend

- Flow Direction
- Streams (Pierce County 2021)
- Estimated ditch centerline
- Surveyed ditches
- Culverts
- Wetland
- Stream
- Estimated OHWM
- Delineated OHWM

Figure D-40a.
Flow Directions and Features Associated with Wetland 93.

N

0 75 150 300 Feet

HERRERA

ESRI, Aerial (2020)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_FlowDirection_WLX_letter.mxd



Legend

- Contributing basin
- Wetland
- Delineated wetland boundary

Figure D-41.
Map of Contributing Basin for Wetland 93.


N

0 75 150 300 Feet

HERRERA

Esri, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_ContributingBasin_WLX_letter.mxd

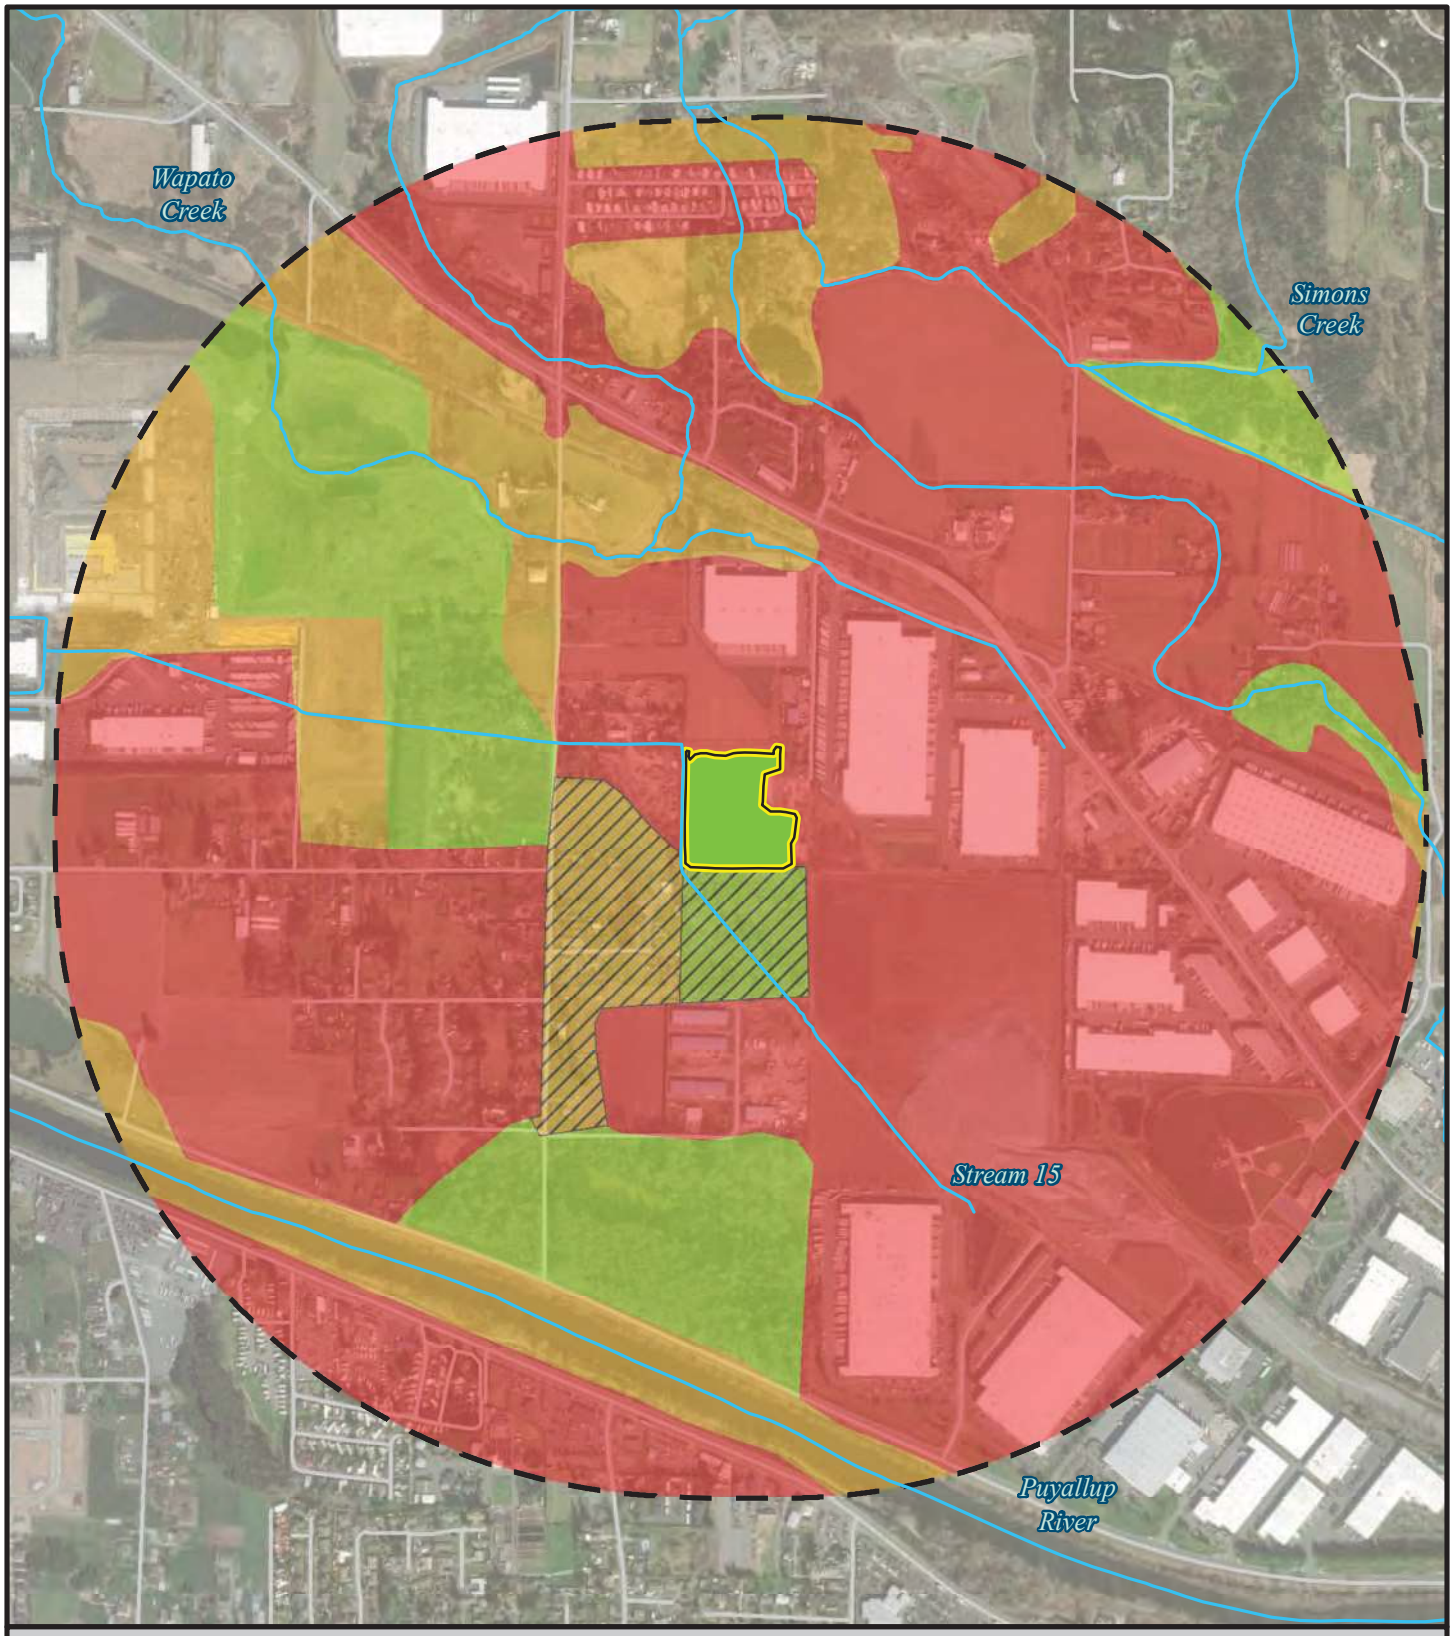

Legend

- Delineated wetland boundary
- 1-km boundary
- Wetland
- Stream (Pierce County)

Habitat type

- High intensity
- Low/Moderate Intensity
- Low/Moderate Intensity and accessible
- Relatively undisturbed
- Relatively undisturbed and accessible

Figure D-42.
Habitat Within a 1-km Boundary of Wetland 93.

N

0 500 1,000 2,000 Feet

HERRERA

Esri, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Project\GISWorking\Wetland_Delineation2021\Ratings_Figures\FigX_Habitat1KM_WLX_letter.mxd

Wetland name or number: Wetland 146/148

RATING SUMMARY – Western Washington

Name of wetland (or ID #): SR 167 Completion Project – Wetland 146/148 Date of site visit: 11/30/2022

Rated by J. Hearsey Trained by Ecology? ☒ Yes ☐ No Date of Training 2016

HGM Class used for rating Depressional Wetland has multiple HGM classes? ☐ Yes ☒ No

Additional HGM Classes (*if multiple*):

Source of base aerial photo/map ESRI Aerial, 2020

OVERALL WETLAND CATEGORY III (based on functions ☒ or special characteristics ☐)

1. Category of wetland based on FUNCTIONS

Category III – Total score = 16 – 19

FUNCTION	Improving Water Quality	Hydrologic	Habitat	
Enter the appropriate ratings				
Site Potential	M	L	L	
Landscape Potential	H	H	L	
Value	H	M	M	**TOTAL**
Score Based on Ratings	8	6	4	18

Score for each function based on three ratings

(*order of ratings is not important*)

9 = H,H,H

8 = H,H,M

7 = H,H,L

7 = H,M,M

6 = H,M,L

6 = M,M,M

5 = H,L,L

5 = M,M,L

4 = M,L,L

3 = L,L,L

2. Category based on SPECIAL CHARACTERISTICS of wetland

CHARACTERISTIC	CATEGORY
Estuarine	
Wetland of High Conservation Value	
Bog	
Mature Forest	
Old Growth Forest	
Coastal Lagoon	
Interdunal	
None of the above	**X**

Maps and figures required to answer questions correctly for Western Washington

Depressional Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	D 1.3, H 1.1, H 1.4	B-23
Hydroperiods	D 1.4, H 1.2	B-24
Flow directions and associated features	n/a	B-24a
Location of outlet (*can be added to map of hydroperiods)*	D 1.1, D 4.1	B-24
Boundary of area within 150 ft of the wetland *(can be added to another figure)*	D 2.2, D 5.2	B-24
Map of the contributing basin	D 4.3, D 5.3	B-25
1 km Polygon: Area that extends 1 km from entire wetland edge—including polygons for accessible habitat and undisturbed habitat	H 2.1, H 2.2, H 2.3	B-26
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	D 3.1, D 3.2	B-5
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	D 3.3	B-6

Wetland name or number: Wetland 146/148

DEPRESSIONAL AND FLATS WETLANDS

Water Quality Functions – Indicators that the site functions to improve water quality

D 1.0. Does the site have the potential to improve water quality?	
D 1.1. Characteristics of surface water outflows from the wetland: Wetland has an intermittently flowing stream or ditch | points = 2	2
D 1.2. The soil 2 in below the surface (or duff layer) is true clay or true organic *(use NRCS definitions).* No = 0	0
D 1.3. Characteristics and distribution of persistent plants (Emergent, Scrub-shrub, and/or Forested Cowardin classes): Wetland has persistent, ungrazed plants > 95% of area | points = 5	5
D 1.4. Characteristics of seasonal ponding or inundation: *This is the area that is ponded for at least 2 months. See description in manual.* Area seasonally ponded is < 1/4 total area of wetland | points = 0	0
Total for D 1 Add the points in the boxes above (F9 key)	7

Rating of Site Potential If score is: 6–11 = M *Record the rating on the first page*

D 2.0. Does the landscape have the potential to support the water quality function of the site?	
D 2.1. Does the wetland unit receive stormwater discharges? Yes = 1	1
D 2.2. Is >10% of the area within 150 ft of the wetland in land uses that generate pollutants? Yes = 1	1
D 2.3. Are there septic systems within 250 ft of the wetland? Yes = 1	1
D 2.4. Are there other sources of pollutants coming into the wetland that are not listed in questions D 2.1–D 2.3? Source: No = 0	0
Total for D 2 Add the points in the boxes above	3

Rating of Landscape Potential If score is: 3 or 4 = H *Record the rating on the first page*

D 3.0. Is the water quality improvement provided by the site valuable to society?	
D 3.1. Does the wetland discharge directly (i.e., within 1 mi) to a stream, river, lake, or marine water that is on the 303(d) list? No = 0	0
D 3.2. Is the wetland in a basin or subbasin where an aquatic resource is on the 303(d) list? Yes = 1	1
D 3.3. Has the site been identified in a watershed or local plan as important for maintaining water quality (*answer YES if there is a TMDL for the basin in which the unit is found*)? Yes = 2	2
Total for D 3 Add the points in the boxes above	3

Rating of Value If score is: 2–4 = H *Record the rating on the first page*

COMMENTS: D 2.2: The wetland is adjacent to industrial truck yard with road asphalt and concrete disposal, derelict equipment, and demolition material. D 2.3: Pierce County GIS data indicates homes are outside of sewer service areas. D 3.1: The wetland outlets to Stream 15 which flows for approximately 1.5 miles to Oxbow Lake and eventually the Puyallup River downstream of mapped 303(d). D 3.2 and D 3.3. The wetland is in the Puyallup River basin (HUC 12), which contains 303(d) listed waters and has TMDLs in place.

Hydrologic Functions – Indicators that the site functions to reduce flooding and stream degradation

D 4.0. Does the site have the potential to reduce flooding and erosion?	
D 4.1. Characteristics of surface water outflows from the wetland: Wetland has an intermittently flowing stream or ditch | points = 2	2
D 4.2. Depth of storage during wet periods: *Estimate the height of ponding above the bottom of the outlet. For wetlands with no outlet, measure from the surface of permanent water or if dry, the deepest part.* Marks of ponding less than 0.5 ft (6 in) | points = 0	0
D 4.3. Contribution of the wetland to storage in the watershed: *Estimate the ratio of the area of upstream basin contributing surface water to the wetland to the area of the wetland unit itself.* The area of the basin is 10 to 100 times the area of the unit | points = 3	3
Total for D 4 Add the points in the boxes above	5

Rating of Site Potential If score is: 0–5 = L *Record the rating on the first page*

Wetland name or number: Wetland 146/148

D 5.0. Does the landscape have the potential to support hydrologic functions of the site?		
D 5.1. Does the wetland receive stormwater discharges?	Yes = 1	1
D 5.2. Is >10% of the area within 150 ft of the wetland in land uses that generate excess runoff?	Yes = 1	1
D 5.3. Is more than 25% of the contributing basin of the wetland covered with intensive human land uses (residential at >1 residence/ac, urban, commercial, agriculture, etc.)?	Yes = 1	1
Total for D 5	Add the points in the boxes above	3

Rating of Landscape Potential If score is: 3 = H *Record the rating on the first page*

D 6.0. Are the hydrologic functions provided by the site valuable to society?	
D 6.1. The unit is in a landscape that has flooding problems. *Choose the description that best matches conditions around the wetland unit being rated. Do not add points. Choose the highest score if more than one condition is met.* The wetland captures surface water that would otherwise flow down-gradient into areas where flooding has damaged human or natural resources (e.g., houses or salmon redds): Surface flooding problems are in a subbasin farther down-gradient | points = 1 **If not applicable chosen above:** The existing or potential outflow from the wetland is so constrained by human or natural conditions that the water stored by the wetland cannot reach areas that flood. Explain why. | points = 0 **Explanation for 0 points (if required above): designed for infiltration with no inlet or outlets**	1
D 6.2. Has the site been identified as important for flood storage or flood conveyance in a regional flood control plan? No = 0	0
Total for D 6 Add the points in the boxes above	1

Rating of Value If score is: 1 = M *Record the rating on the first page*


COMMENTS:

These questions apply to wetlands of all HGM classes.

HABITAT FUNCTIONS – Indicators that site functions to provide important habitat

H 1.0. Does the site have the potential to provide habitat?		
H 1.1. Structure of plant community: *Indicators are Cowardin classes and strata within the Forested class.* Check the Cowardin plant classes in the wetland. *Up to 10 patches may be combined for each class to meet the threshold of 1/4 ac or more than 10% of the unit if it is smaller than 2.5 ac. Add the number of structures checked.* ☐ Aquatic bed ☒ Emergent ☒ Scrub-shrub (areas where shrubs have >30% cover) ☐ Forested (areas where trees have >30% cover) *If the unit has a Forested class, check if:* ☐ The Forested class has 3 out of 5 strata (canopy, sub-canopy, shrubs, herbaceous, moss/ground-cover) that each cover 20% within the Forested polygon	2 structures | points = 1	1

Wetland name or number: Wetland 146/148

H 1.2. Hydroperiods Check the types of water regimes (hydroperiods) present within the wetland. The water regime has to cover more than 10% of the wetland or 1/4 ac to count (*see text for descriptions of hydroperiods*). ☐ Permanently flooded or inundated ☐ Seasonally flooded or inundated ☐ Occasionally flooded or inundated ☒ Saturated only ☐ Permanently flowing stream or river in, or adjacent to, the wetland ☒ Seasonally flowing stream in, or adjacent to, the wetland ☐ **Lake Fringe wetland** **2 points** ☐ **Freshwater tidal wetland** **2 points** 2 types present | points = 1	1
H 1.3. Richness of plant species Count the number of plant species in the wetland that cover at least 10 ft^2. *Different patches of the same species can be combined to meet the size threshold and you do not have to name the species*. ***Do not include Eurasian milfoil, reed canarygrass, purple loosestrife, Canadian thistle.*** If you counted: 5–19 species | points = 1	1
H 1.4. Interspersion of habitats Decide from the diagrams below whether interspersion among Cowardin plants classes (described in H 1.1), or the classes and unvegetated areas (can include open water or mudflats) is high, moderate, low, or none. *If you have four or more plant classes or three classes and open water, the rating is always high.* Low | points = 1 **None** = 0 points  **Low** = 1 point  **Moderate** = 2 points  All three diagrams in this row are **HIGH** = 3 points 	1
H 1.5. Special habitat features: Check the habitat features that are present in the wetland. *The number of checks is the number of points*. ☐ Large, downed, woody debris within the wetland (>4 in diameter and 6 ft long). ☐ Standing snags (dbh >4 in) within the wetland ☐ Undercut banks are present for at least 6.6 ft (2 m) **and/or** overhanging plants extends at least 3.3 ft (1 m) over a stream (or ditch) in, or contiguous with the wetland, for at least 33 ft (10 m) ☐ Stable steep banks of fine material that might be used by beaver or muskrat for denning (>30 degree slope) OR signs of recent beaver activity are present (*cut shrubs or trees that have not yet weathered where wood is exposed*) ☐ At least 1/4 ac of thin-stemmed persistent plants or woody branches are present in areas that are permanently or seasonally inundated (*structures for egg-laying by amphibians*) ☐ Invasive plants cover less than 25% of the wetland area in every stratum of plants (*see H 1.1 for list of strata*)	0
Total for H 1 Add the points in the boxes above	4

Rating of Site Potential If score is: 0–6 = L *Record the rating on the first page*

H 2.0. Does the landscape have the potential to support the habitat functions of the site?	
H 2.1. Accessible habitat (include *only habitat that directly abuts wetland unit*). *Calculate*: % undisturbed habitat 0.0 **+** [(% moderate and low intensity land uses) 0.6/2] **0.3** **=** 0.0% If total accessible habitat is: <10% of 1 km Polygon | points = 0	0
H 2.2. Undisturbed habitat in 1 km Polygon around the wetland. *Calculate*: % undisturbed habitat 13.0 **+** [(% moderate and low intensity land uses)20.0/2] 10.0 **=** **23.0**% Undisturbed habitat 10–50% and >3 patches | points = 1	1
H 2.3. Land use intensity in 1 km Polygon: If >50% of 1 km Polygon is high intensity land use | points = (-2)	-2

Wetland name or number: Wetland 146/148

Total for H 2	Add the points in the boxes above	-1
Rating of Landscape Potential	If score is: < 1 = L	*Record the rating on the first page*

H 3.0. Is the habitat provided by the site valuable to society?

H 3.1. Does the site provide habitat for species valued in laws, regulations, or policies? *Choose only the highest score that applies to the wetland being rated.* — 1

WDFW Priority Habitats within 100 m:

☐ Aspen Stands	☐ Biodiversity Areas and Corridors	☐ Herbaceous Balds
☐ Old Growth/Mature Forests	☐ Oregon White Oak	☒ Riparian
☐ Westside Prairies	☒ Instream	☐ Nearshore
☐ Caves	☐ Cliffs	☐ Talus
☐ Snags and Logs		

(*Priority habitats listed by WDFW: For complete descriptions of WDFW priority habitats, and the counties in which they can be found, see: Washington Department of Fish and Wildlife. 2008. Priority Habitat and Species List. Olympia, Washington,* <http://wdfw.wa.gov/publications/00165/wdfw00165.pdf>, *or access the list from here:* <https://wdfw.wa.gov/species-habitats/at-risk/phs/list>.)

Site meets ANY of the following criteria: points = 2

- ☐ It has 3 or more priority habitats within 100 m (checked above)
- ☐ It provides habitat for Threatened or Endangered species (any plant or animal on the state or federal lists)
- ☐ It is mapped as a location for an individual WDFW priority species
- ☐ It is a Wetland of High Conservation Value as determined by the Department of Natural Resources
- ☐ It has been categorized as an important habitat site in a local or regional comprehensive plan, in a Shoreline Master Plan, or in a watershed plan

Site has 1 or 2 priority habitats within 100 m (checked above) points = 1

Site does not meet any of the criteria above points = 0

Rating of Value	If score is: 1 = M	*Record the rating on the first page*



Legend

- Stream
- Delineated wetland boundary
- Estimated wetland boundary

Cowardin class

- PEM - Palustrine emergent
- PSS - Palustrine scrub-shrub

Figure **B-23**.
Cowardin Classes for Wetland 146/148.


N

0 55 110 220 Feet

HERRERA

ESRI, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Pro\WSAR_Rating_Figures_Stage2\WSAR_Rating_Figures_Stage2.aprx\FigX_CowardinClass_WLX

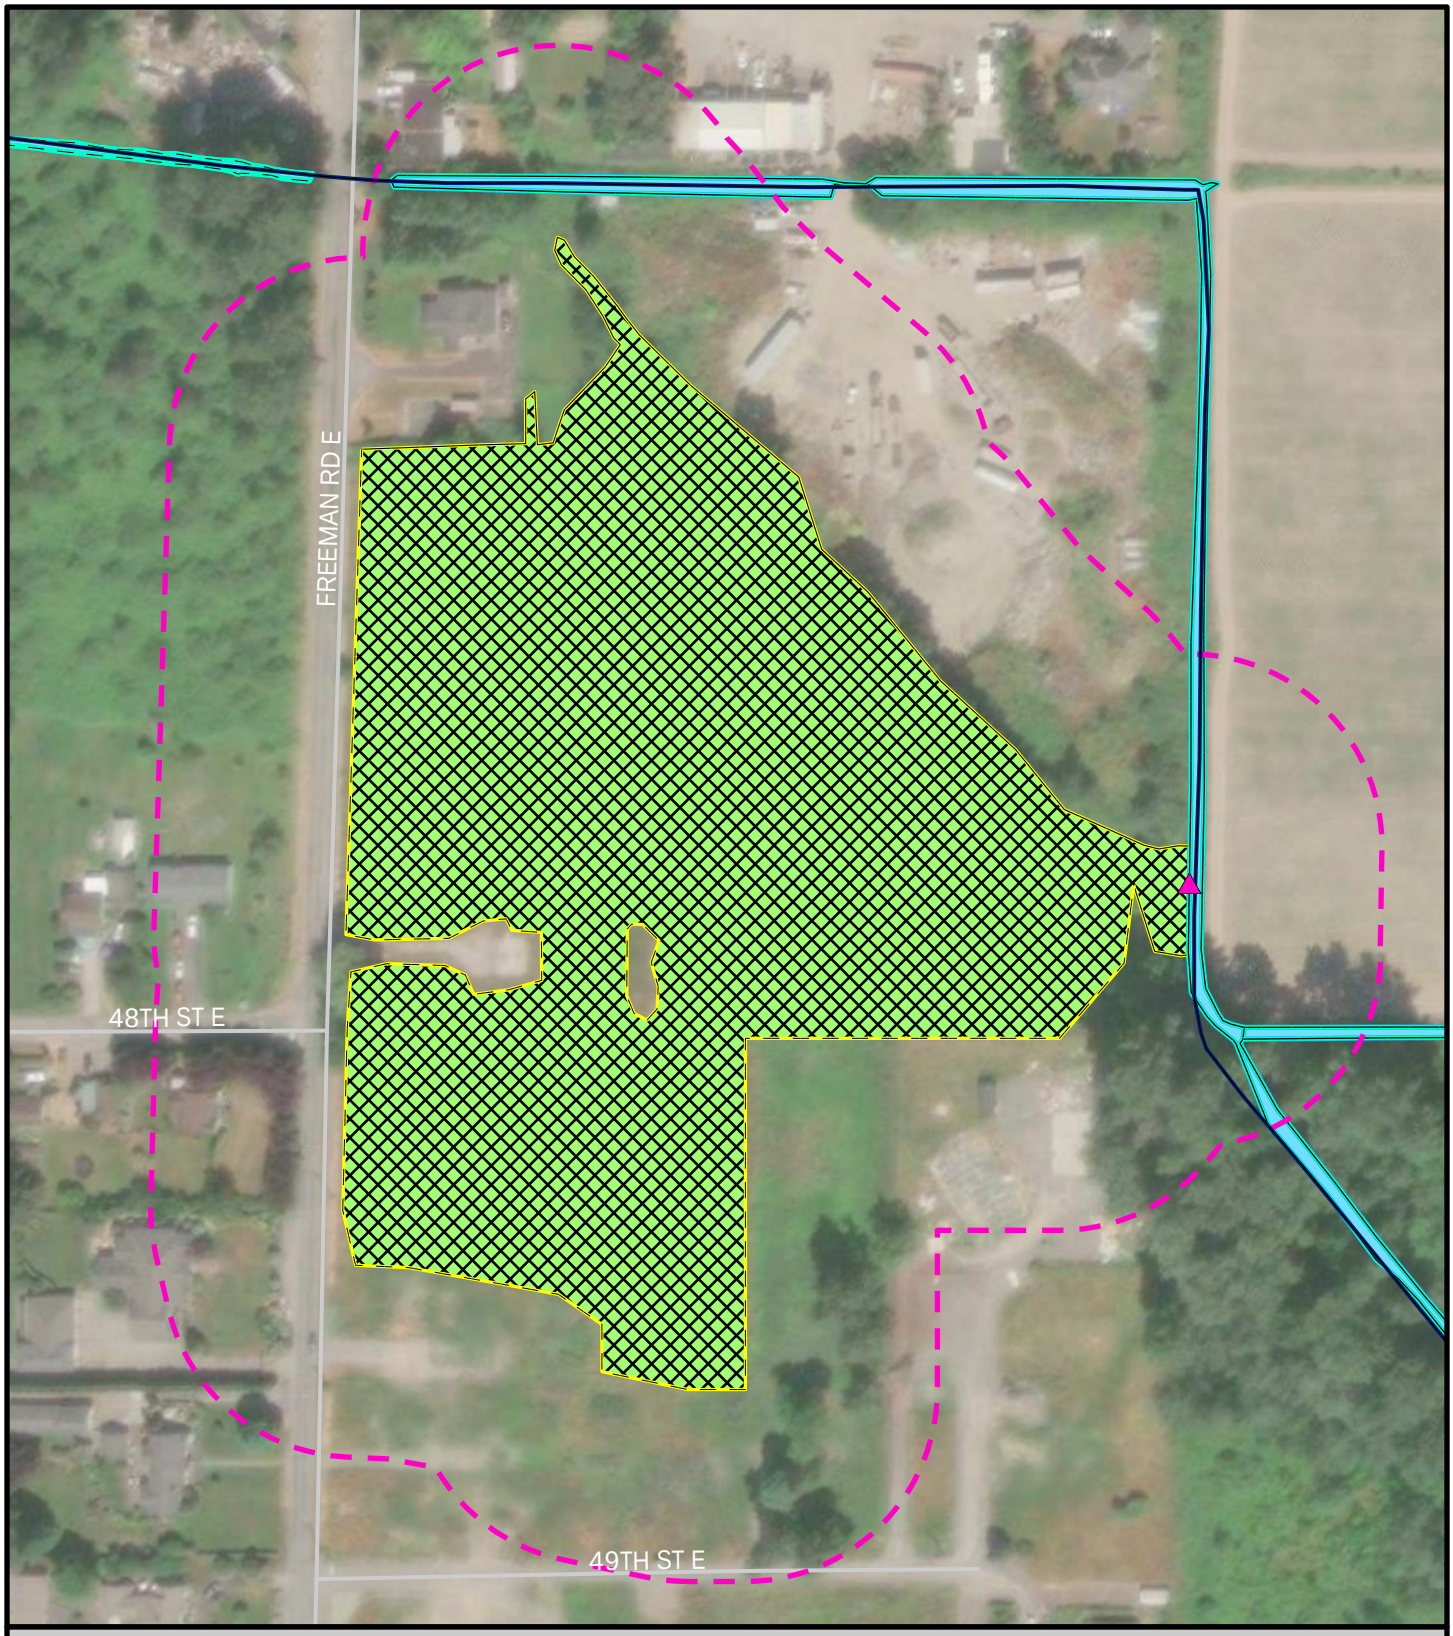

Legend

- Stream (Pierce County 2021)
- Delineated wetland boundary
- Estimated wetland boundary
- Delineated OHWM
- Estimated OHWM
- Wetland
- Stream
- 150ft boundary
- Outlet

Hydroperiod

- Saturated only

Figure **B-24**.
Hydroperiod, 150-Foot Boundary, and Location of Outlets for Wetland 146/148.


N

0 75 150 300 Feet

HERRERA

Esri, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Pro\WSAR_Rating_Figures_Stage2\WSAR_Rating_Figures_Stage2.aprx\FigX_Hydroperiods_WLX

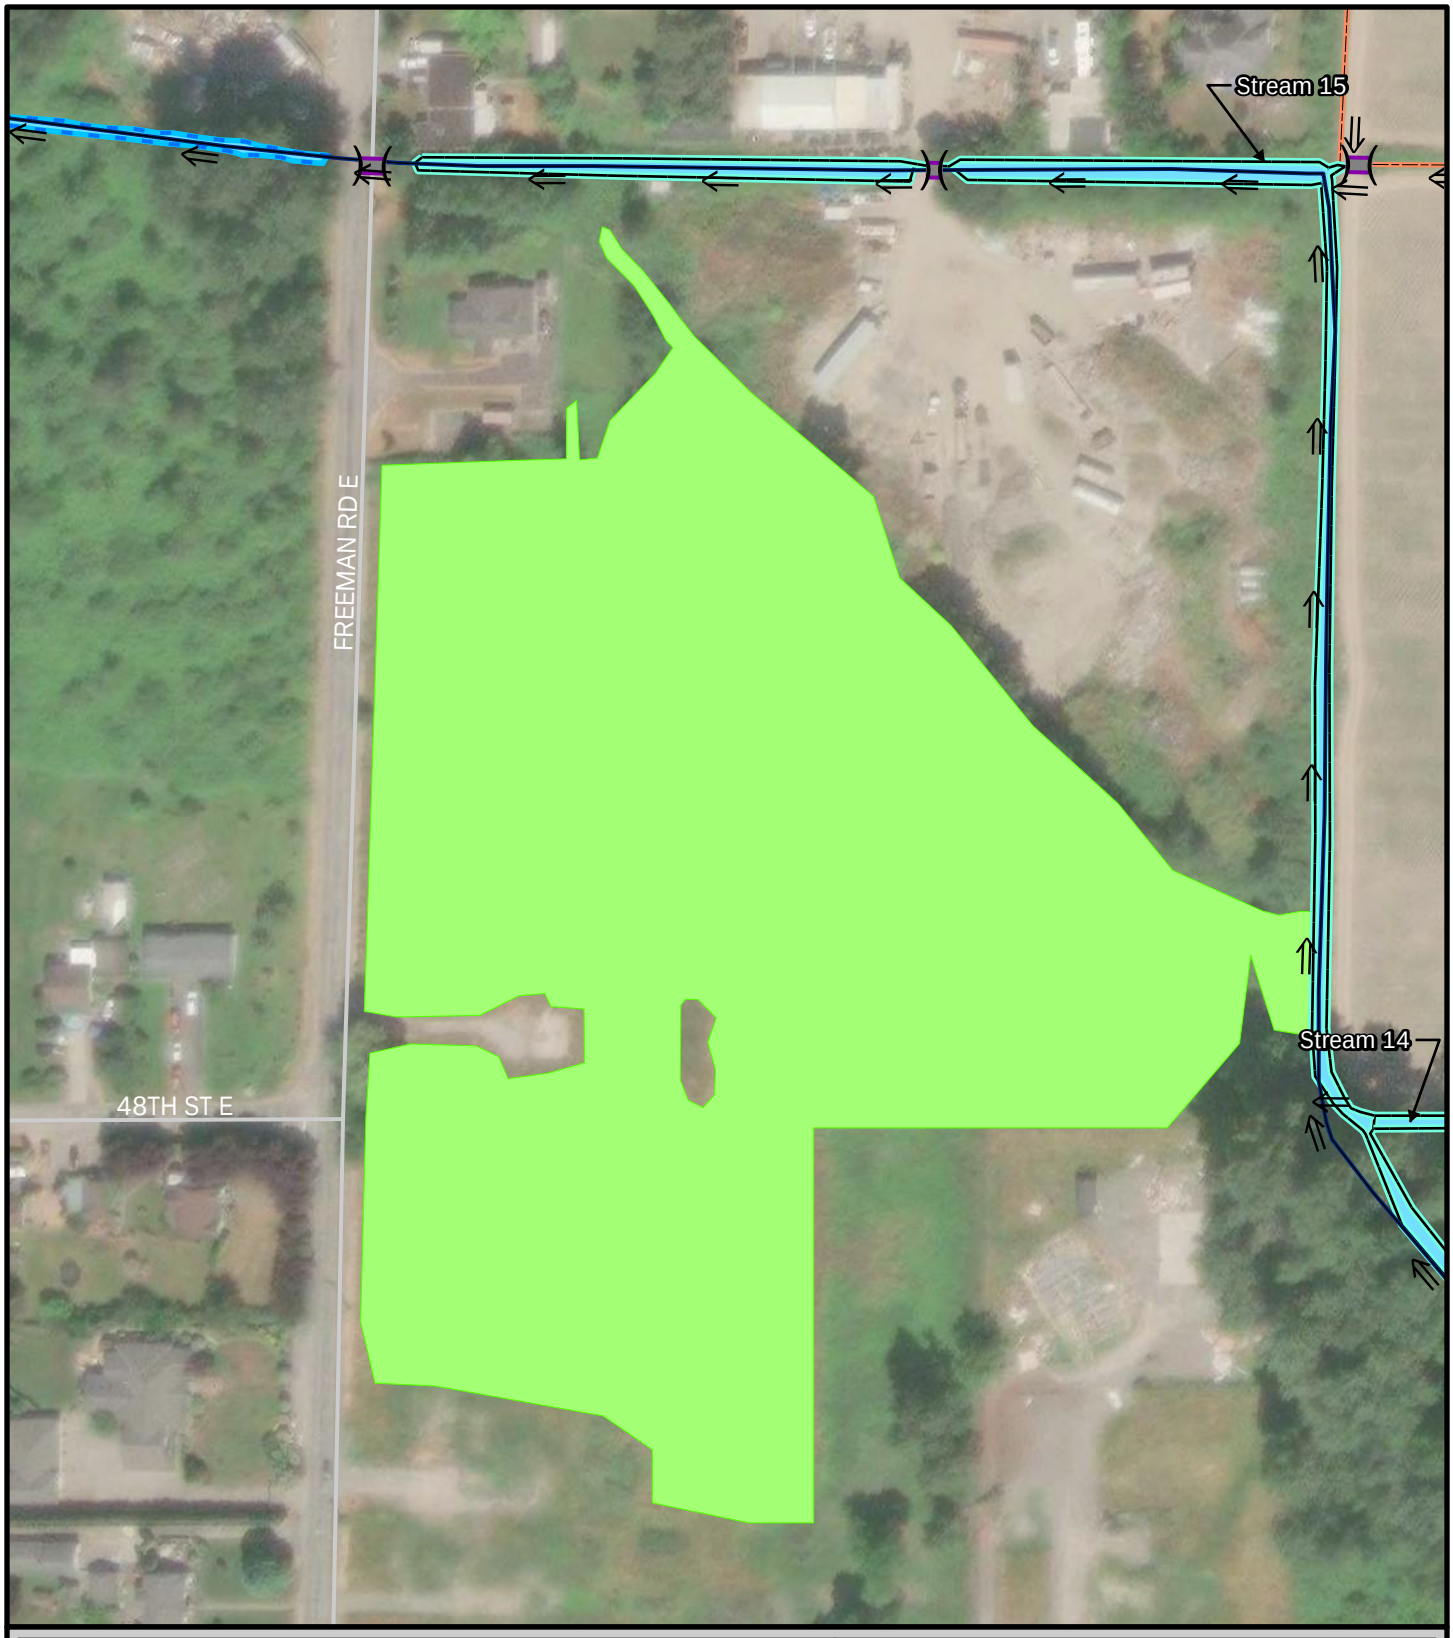

Legend

- Flow Direction
- Streams (Pierce County 2021)
- Estimated ditch centerline
- Culverts
- Wetland
- Stream
- Estimated OHWM
- Delineated OHWM

Figure B-24a.
Flow Directions and Features Associated with Wetland 146/148.


N

0 65 130 260 Feet

HERRERA

Esri, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Pro\WSAR_Rating_Figures_Stage2\WSAR_Rating_Figures_Stage2.aprx\FigX_FlowDirection_WLX

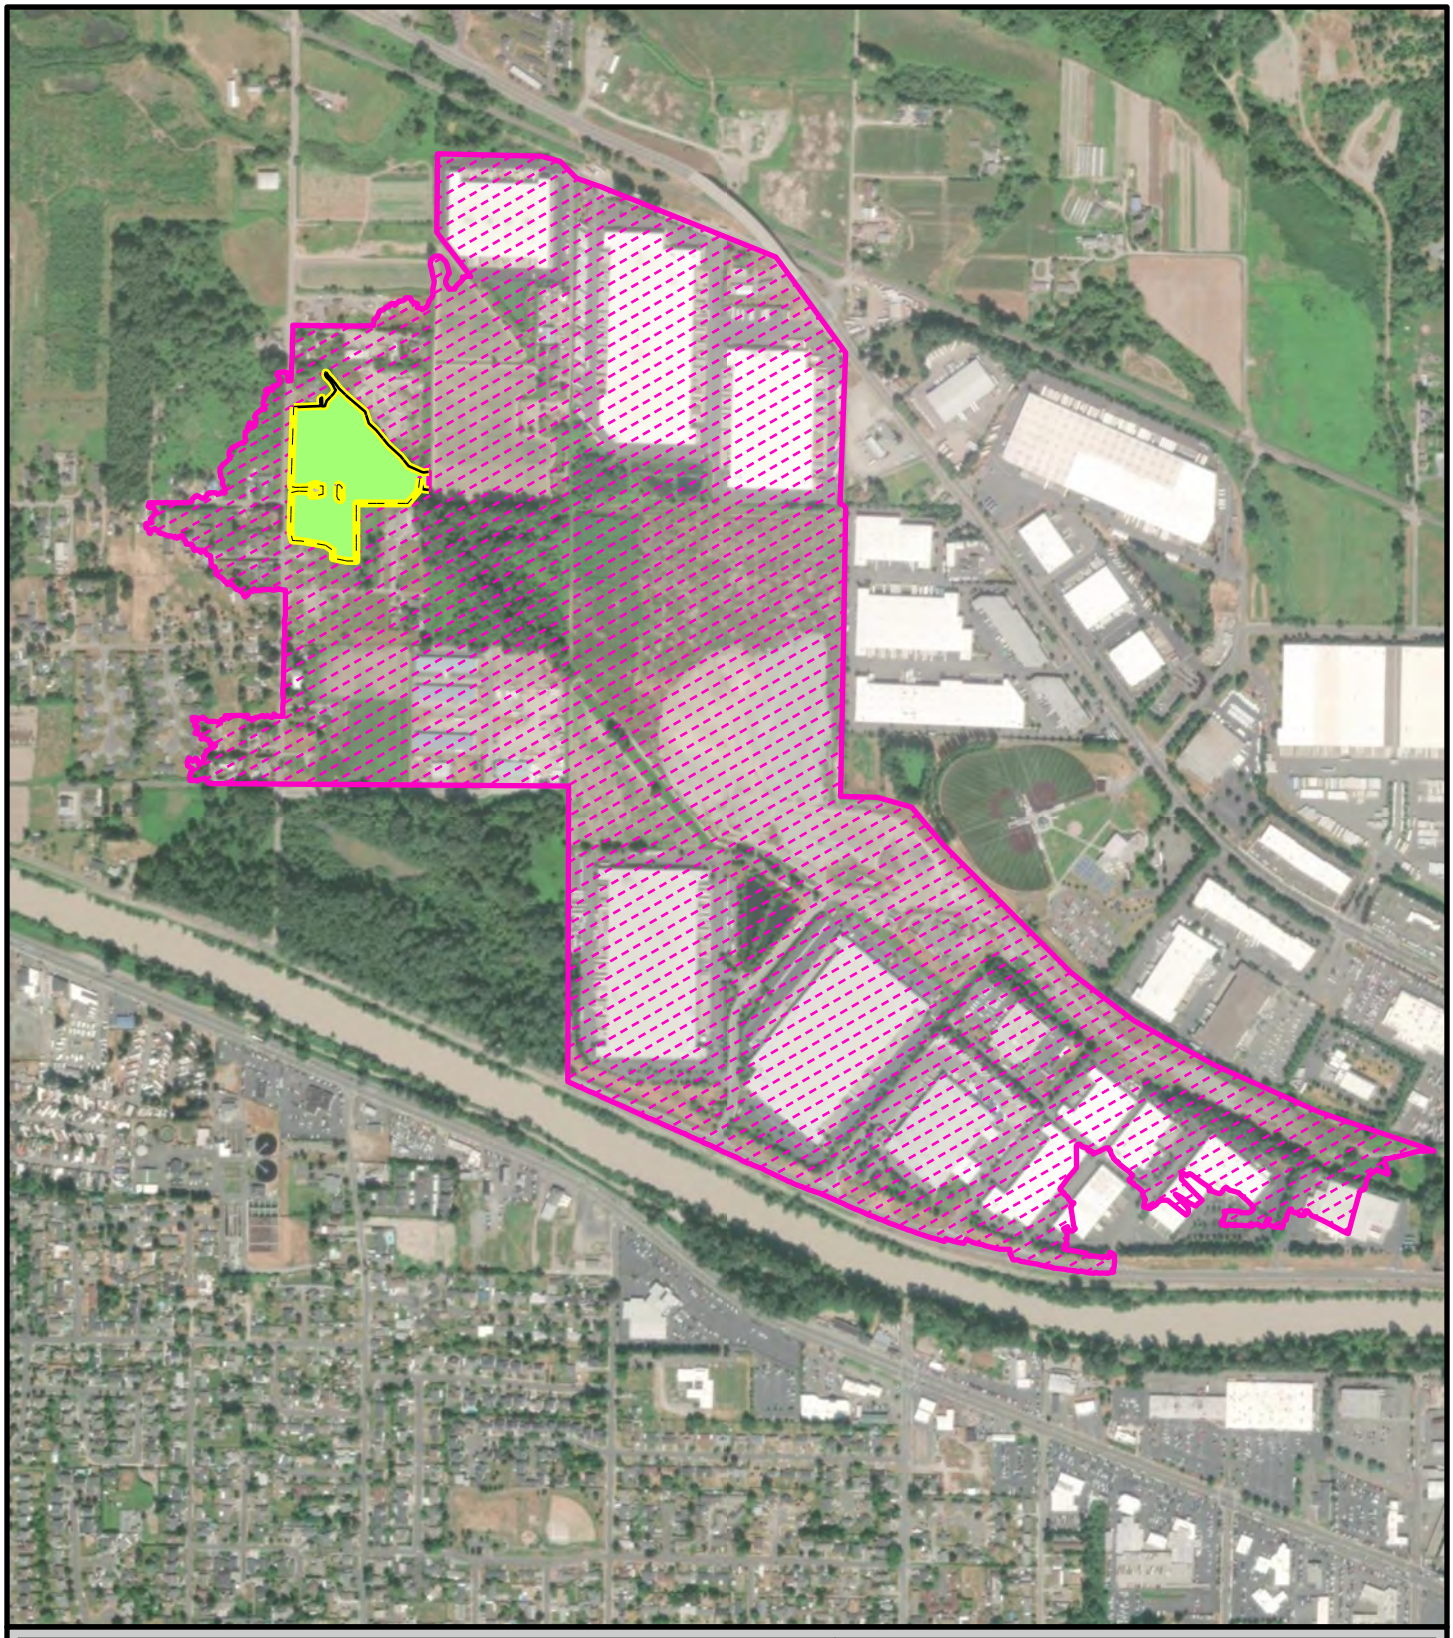

Legend

- Contributing basin
- Wetland
- Delineated wetland boundary
- Estimated wetland boundary

Figure B-25.
Map of Contributing Basin for Wetland 146/148.


N

0 460 920 1,840 Feet

HERRERA

Esri, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Pro\WSAR_Rating_Figures_Stage2\WSAR_Rating_Figures_Stage2.aprx\FigX_ContributingBasin_WLX

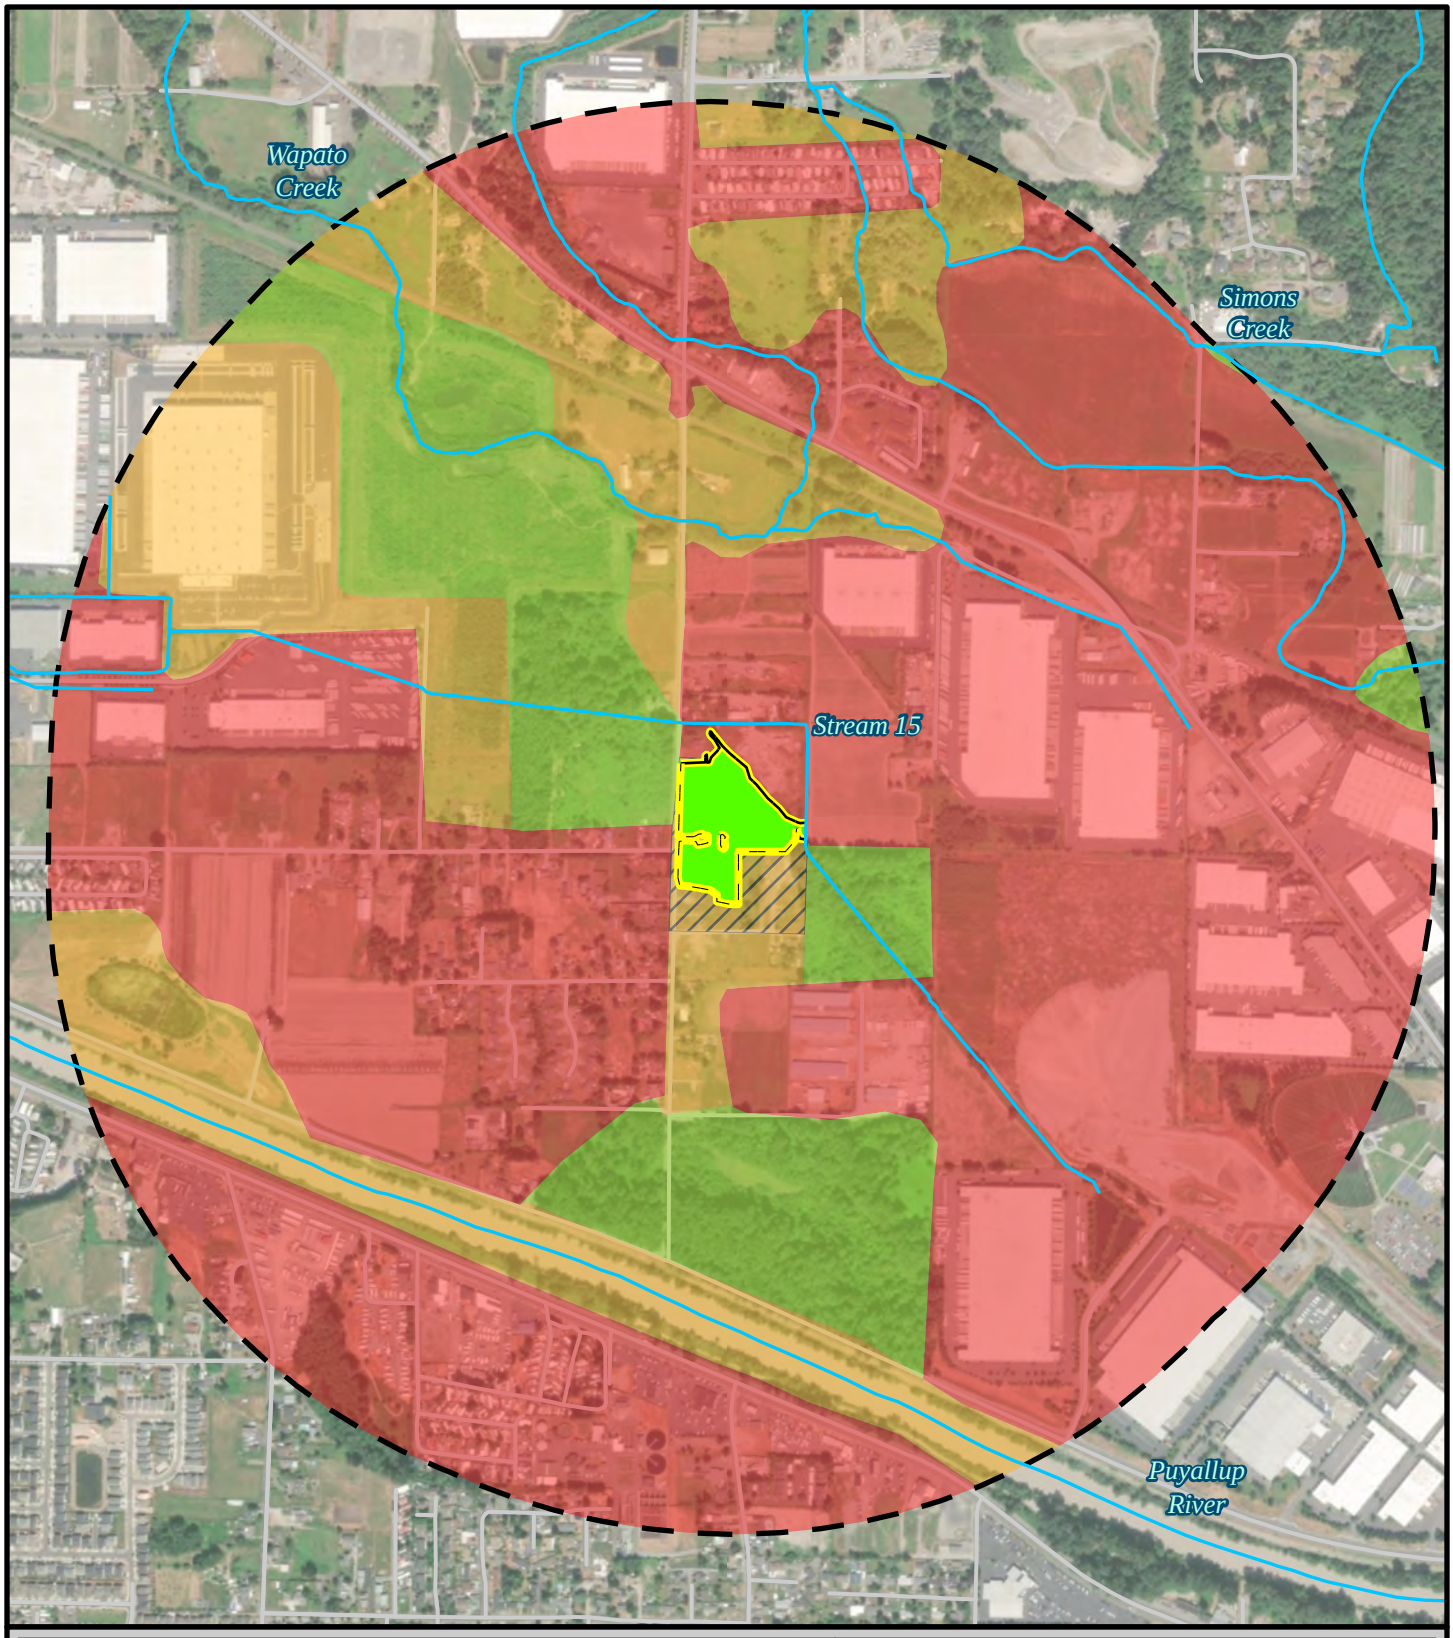

Legend

- Delineated wetland boundary
- Estimated wetland boundary
- 1-km boundary
- Wetland
- Stream (Pierce County)

Habitat type

- High intensity
- Low/Moderate Intensity and accessible
- Low/Moderate Intensity
- Relatively undisturbed

Figure B-26.
Habitat Within a 1-km Boundary of Wetland 146/148.

N


0 500 1,000 2,000 Feet

HERRERA

Esri, Aerial (2021)

K:\Projects\Y2016\16-06277-000\Pro\WSAR_Rating_Figures_Stage2\WSAR_Rating_Figures_Stage2.aprx\FigX_Habitat1KM_WLX

Appendix D
WSDOT State Route 167 Completion Project Mitigation Excerpts

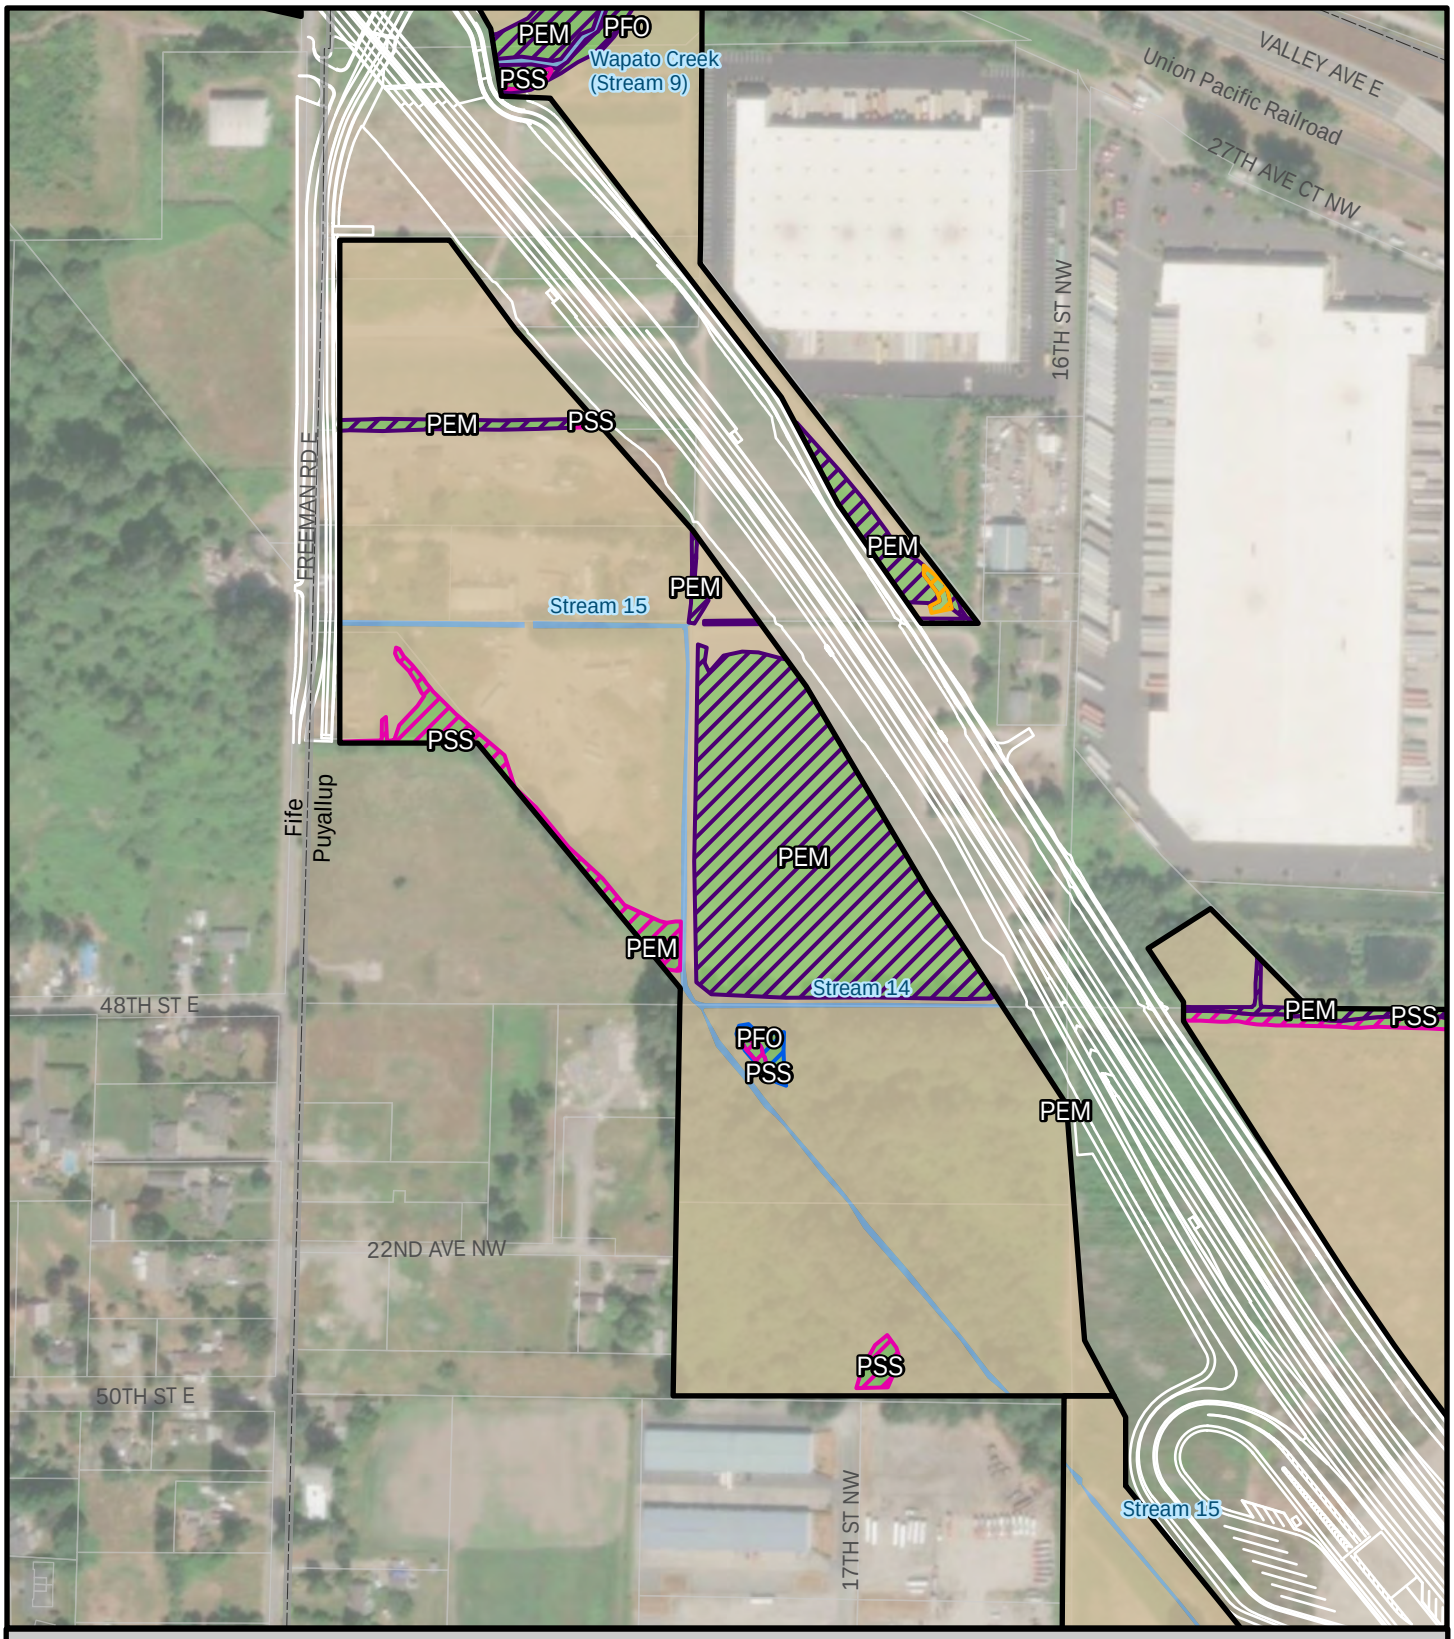

Legend

- Stage 2 RRP Boundary
- Jurisdictional boundary
- Parcel boundaries
- Stage 2 Proposed Road and Shared-Use Path (white line)
- Stream
- Upland
- Wetland
- Bare Ground

CowardinClass

- PEM
- PFO
- PSS


Figure 4-L. Existing Conditions for the SR 167 Completion Project, Stage 2 - Freeman Road Mitigation Site.

0 165 330 660 Feet

HERRERA Science + Planning + Design

Esri Imagery (2023)

K:\Projects\Y2016\16-06277-000\Pro\MitigationPlan_Stage2\MitigationPlan_Stage2.aprx\Fig4_Mitigation_Sites_Existing_Conditions_Stage2
Exported: 8/16/2023 2:36 PM

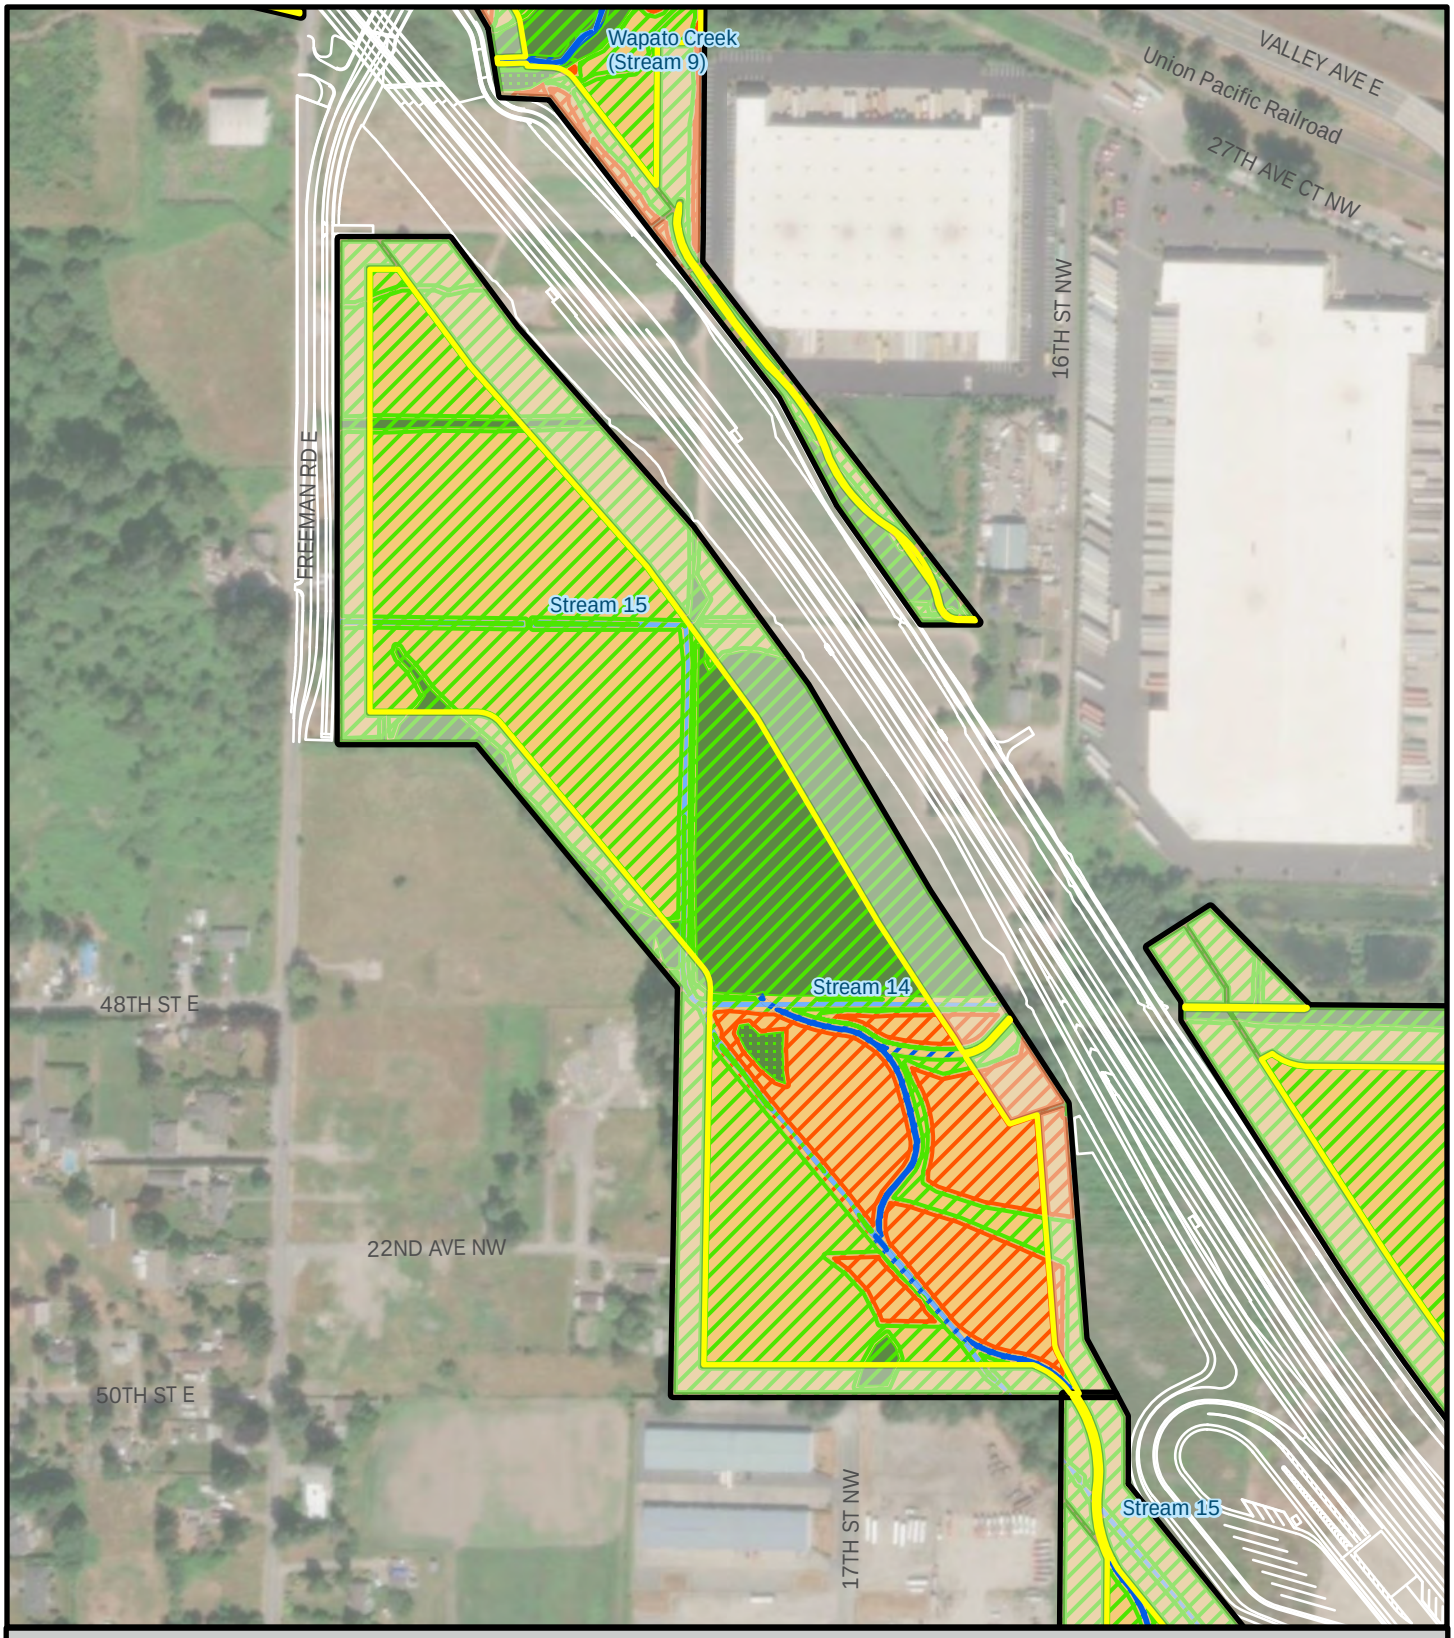

Legend

- Credit-Generating Area
- Mitigation Buffer
- Stage 2 RRP Boundary
- Stage 2 Proposed Road and Shared-Use Path (white line)
- Wetland Reestablishment (Upland to Wetland)
- Stream Creation (Upland to Stream)
- Upland Enhancement (Upland to Upland)
- Stream Enhancement (Stream to Stream)
- Wetland Rehabilitation (Stream to Wetland)
- Stream Creation (Wetland to Stream)
- Wetland Rehabilitation (Wetland to Wetland)
- Wetland Enhancement (Wetland to Wetland)


Figure 5--L. Proposed Conditions for the SR 167 Completion Project, Stage 2 - Freeman Road Mitigation Site.

0 165 330 660 Feet

HERRERA
Science + Planning + Design

Esri Imagery (2023)

K:\Projects\Y2016\16-06277-000\Pro\MitigationPlan_Stage2\MitigationPlan_Stage2.aprx\Fig5_Mitigation_Proposed_Conditions_Stage2
Exported: 8/16/2023 2:37 PM

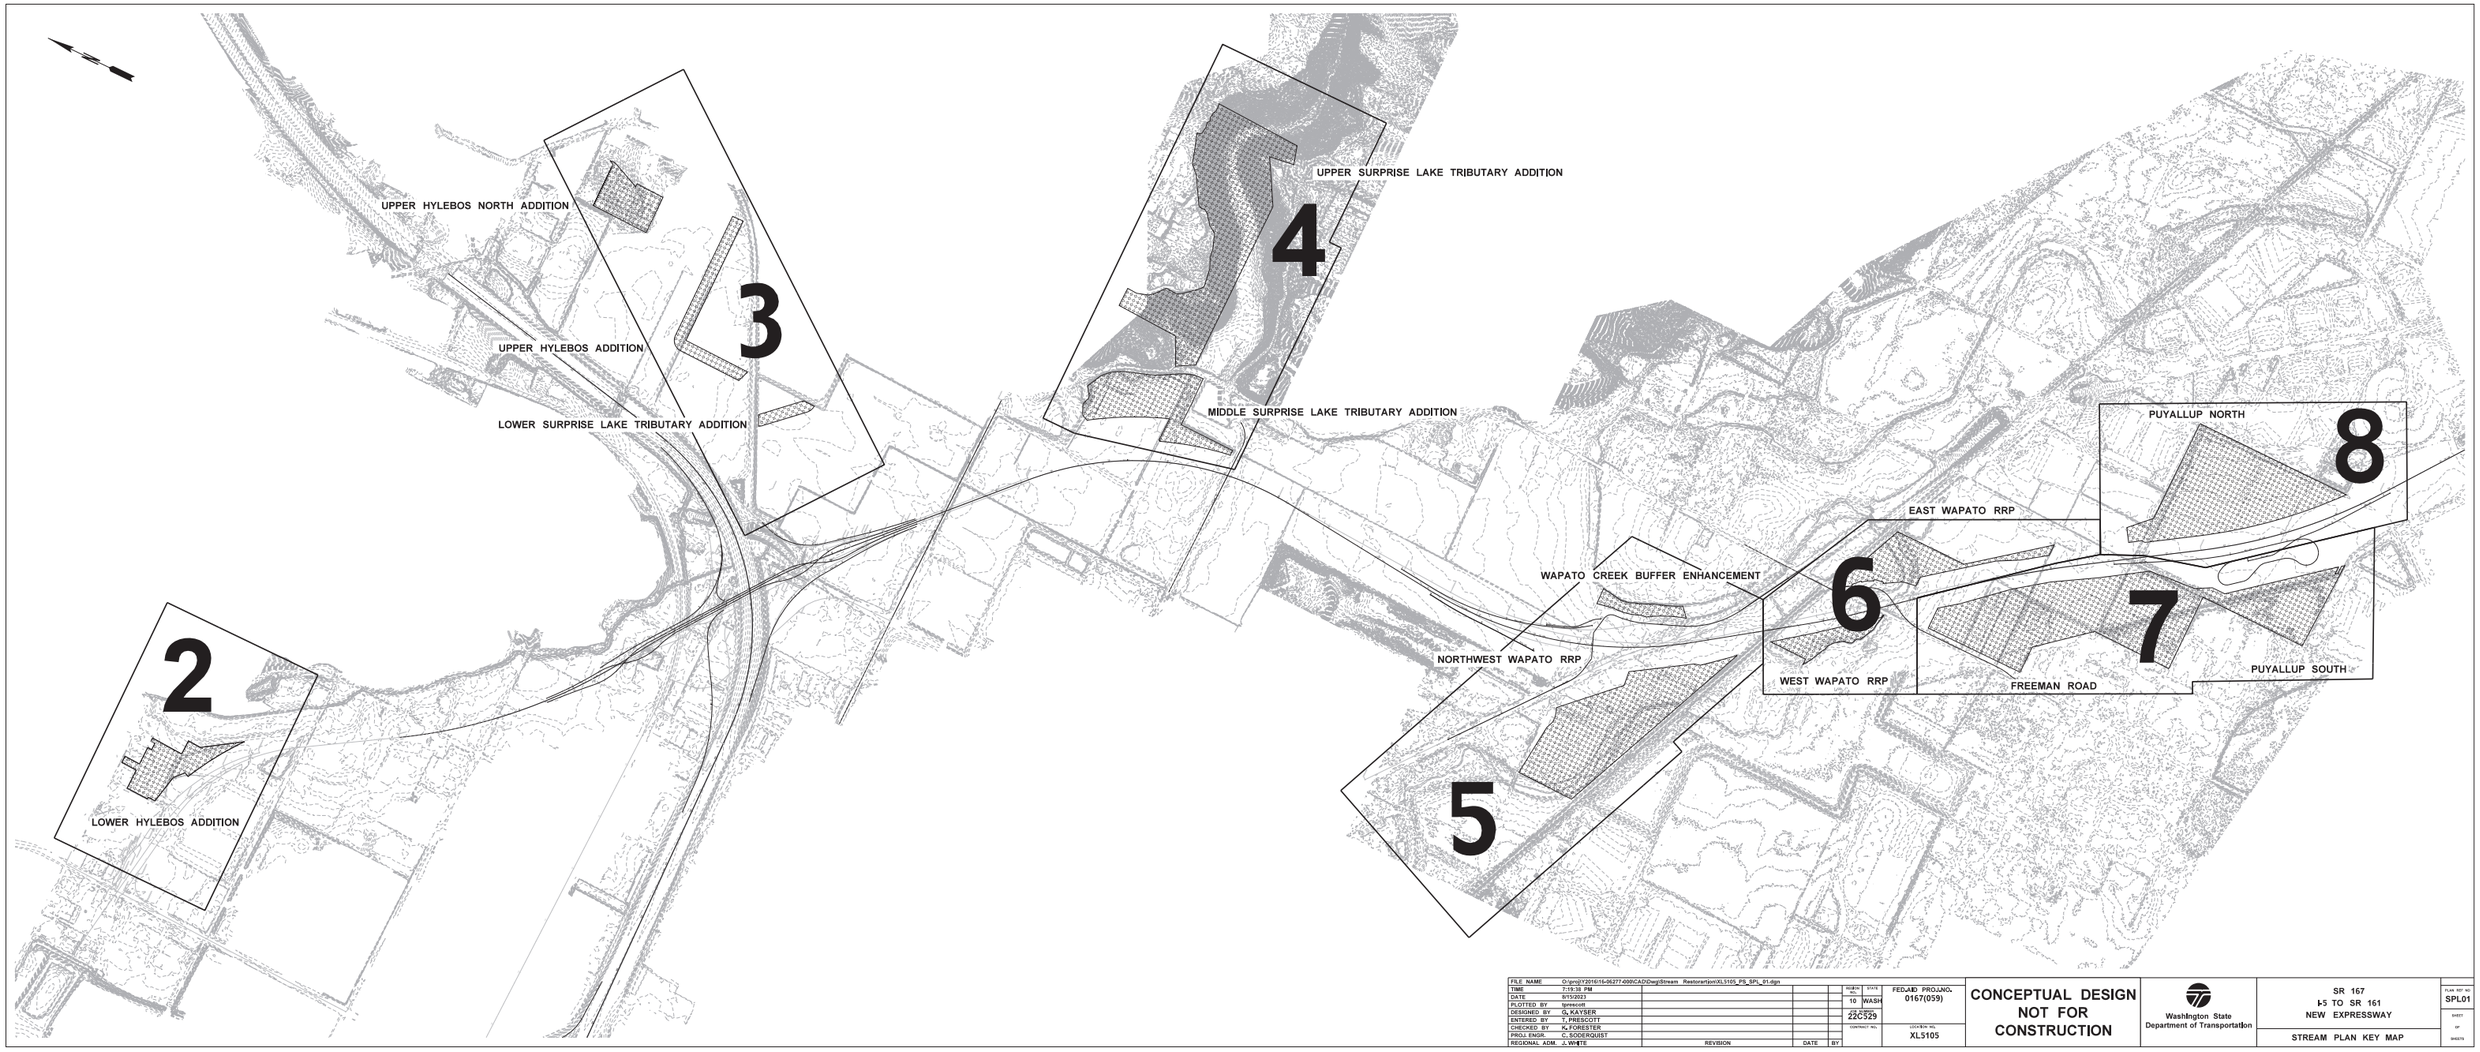

FILE NAME	O:\proj\27201\15-06277-000\CAD\Dwg\Stream Restoration\XL5105_PS_SPL_01.dgn					
TIME	7:19:38 PM					
DATE	8/15/2023					
PLOTTED BY	tpreuer					
DESIGNED BY	G. KAYSER					
ENTERED BY	T. PRESCOTT					
CHECKED BY	K. FORESTER					
PROJ. ENGR.	C. SODERQUIST					
REGIONAL ADM.	A. WHITE	REVISION	DATE	BY		

REGION NO.	STATE	FED.AID PROJ.NO.
10	WASH	0167(059)
JOB NO.		
22C529		
CONTRACT NO.		LOCATION NO.
		XL5105

CONCEPTUAL DESIGN NOT FOR CONSTRUCTION

Washington State Department of Transportation

SR 167
I-5 TO SR 161
NEW EXPRESSWAY

STREAM PLAN KEY MAP

PLAN SET NO.	SPL01
SHEET	
OF	
SHEETS	

LEGEND:


EXISTING	PROPOSED	
		RIGHT OF WAY / LIMITED ACCESS
		COUNTY / CITY RIGHT OF WAY
		PROPERTY LINE
		EASEMENT
2190		WETLAND BOUNDARY
	505	ROADWAY ALIGNMENT
	505	CUT / FILL LINE
		STREAM ALIGNMENT
		CONTOURS (1FT)
	+15.0	SPOT ELEVATIONS
		STAGE 1b MITIGATION AREA BOUNDARY
		STAGE 2 MITIGATION AREA BOUNDARY
		NATIVE VEGETATION PROTECTION ZONE

DESIGN INTENT:

1. THE SOUTH PORTION OF THE FREEMAN ROAD SITE IS A CONTINUATION OF THE CHANNEL AND WETLAND CREATION AREA FROM THE PUYALLUP SOUTH RIPARIAN RESTORATION AREA. THE SOUTHEAST QUADRANT CONTAINS LARGE AREAS OF REMNANT WETLAND FOREST THAT ARE TO BE PROTECTED AND ENHANCED. WHERE NEEDED, GRADING WITHIN THE NATIVE VEGETATION PROTECTION ZONE/FOREST ENHANCEMENT AREA IS INTENDED TO ENHANCE HUMMOCK AND SWALE FEATURES. THE EXISTING MATURE NATIVE VEGETATION, THE SOUTHWEST PORTION OF THE SITE IS DOMINATED BY INVASIVE VEGETATION AND WILL BE GRADED TO MAXIMIZE WETLAND CREATION. THE EXISTING CHANNEL THAT RUNS DIAGONALLY THROUGH THIS AREA WILL BE REGRADED MIDWAY THROUGH THE FOREST TO JOIN THE STREAM CHANNEL, STREAM 14, ENTERING THE SITE FROM THE EAST. THE GOAL OF PUYALLUP SOUTH IS TO CREATE A MORE SINUOUS AND NATURAL DRAINAGE CHANNEL, STREAM 15, THROUGH THE SITE THAT INCREASES CHANNEL LENGTH AND DISTRIBUTES WATER FLOW THROUGHOUT MORE OF THE WETLAND CREATION AREAS.
2. THE AREAS NORTH OF THE EXISTING FORESTED ZONE CONTAIN REMNANT FARM FIELDS. THE EXISTING CHANNEL WILL BE REGRADED THROUGH THE SITE TO CREATE A LONG SINUOUS FLOW PATH THAT ENCOURAGES THE CHANNEL TO INTERACT WITH A RESTORED FLOODPLAIN AND WETLAND CREATION AREAS. AGRICULTURAL AREAS WILL BE GRADED DOWN TO MAXIMIZE WETLAND CREATION, LEAVING VARIED MICROTOPOGRAPHY AND SHALLOW HUMMOCKS TO ENCOURAGE SITE VARIABILITY AND PLANT COMMUNITY DIVERSITY.

NOTES:

1. SEE RRP AND WETLAND MITIGATION PLAN SHEETS FOR NATIVE PROTECTION ZONE BOUNDARY.
2. NO GRADING OR HEAVY MACHINERY WITHIN NATIVE VEGETATION PROTECTION ZONE BOUNDARY.

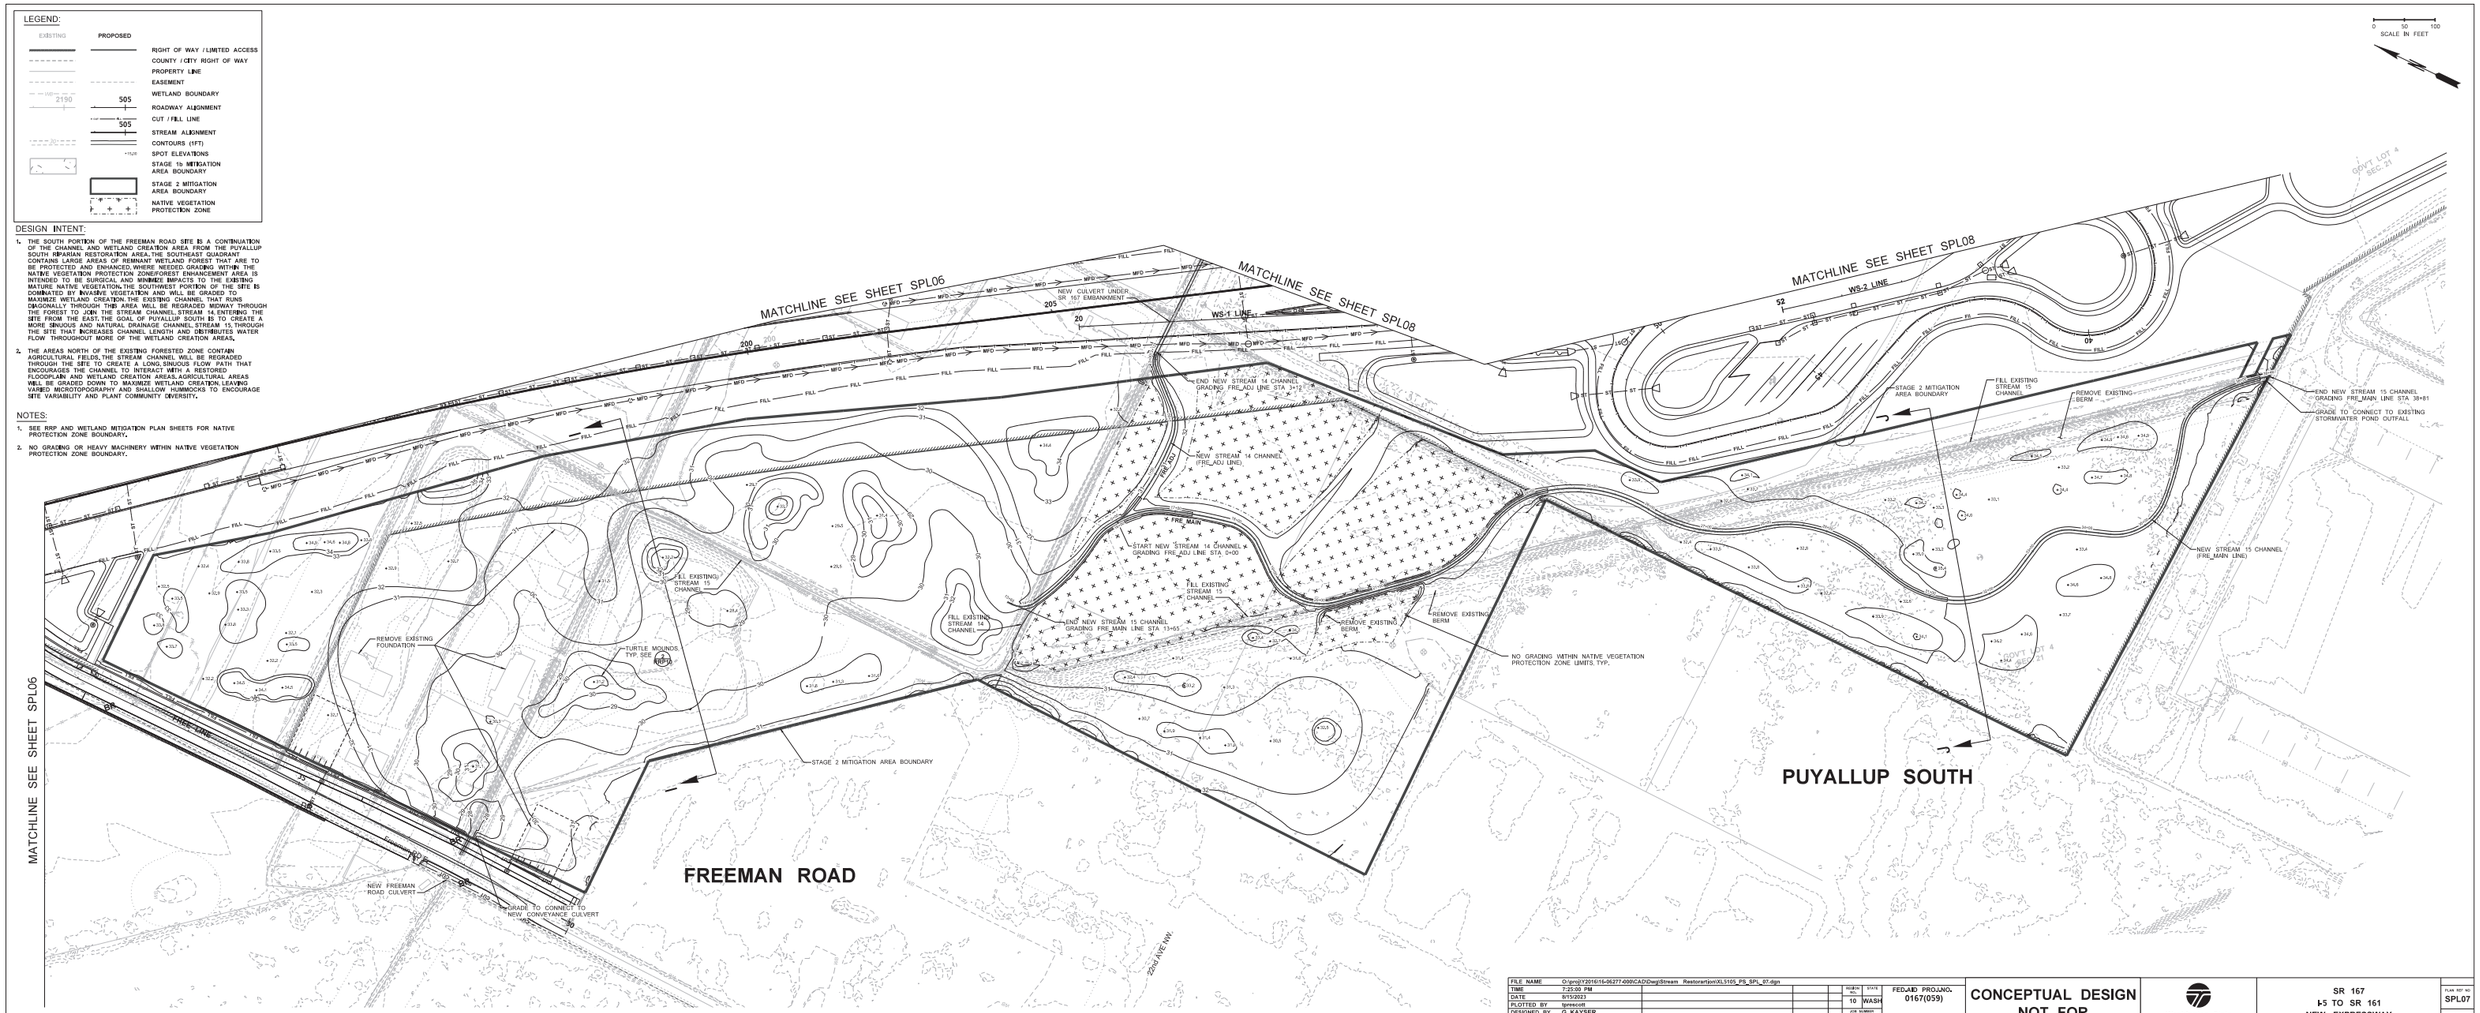

FILE NAME	O:\proj\72016\15-06277-000\CAD\Dwg\Stream Restoration\XL5105_PS_SPL_07.dgn					
TIME	7:25:00 PM					
DATE	8/15/2023					
PLOTTED BY	tprescott					
DESIGNED BY	G. KAYSER					
ENTERED BY	T. PRESCOTT					
CHECKED BY	K. FORESTER					
PROJ. ENGR.	C. SODERQUIST					
REGIONAL ADM.	J. WHITE	REVISION	DATE	BY		

REGION NO.	STATE	FED.AID PROJ.NO.	
10	WASH	0167(059)	
PROJECT NO.			
22C529			
CONTRACT NO.		LOCATION NO.	
		XL5105	

CONCEPTUAL DESIGN NOT FOR CONSTRUCTION

Washington State Department of Transportation

SR 167
I-5 TO SR 161
NEW EXPRESSWAY

STREAM PLAN

PLAN SET NO. SPL07

SHEET OF SHEETS

LEGEND:

EXISTING	PROPOSED	
		RIGHT OF WAY / LIMITED ACCESS
		COUNTY / CITY RIGHT OF WAY
		EASEMENT
		WETLAND BOUNDARY
2190	505	ALIGNMENT
		CUT / FILL LINE
		STREAM THALWEG
		CONTOURS (1FT)
		STAGE 2 MITIGATION AREA BOUNDARY
		NATIVE VEGETATION PROTECTION ZONE
		LARGE WOODY MATERIAL
		BRUSH PILE (HPL13)
		PERCH TREE (HPL10)

NOTES:

1. SEE MITIGATION PLAN DOCUMENT AND TECHNICAL REQUIREMENTS SECTIONS 2.15 AND 2.20 FOR HABITAT FEATURE REQUIREMENTS.

0 50 100
SCALE IN FEET

MATCHLINE SEE SHEET HPL07

MATCHLINE SEE SHEET HPL09

MATCHLINE SEE SHEET HPL08

WS-1 LINE

WS-2 LINE

RRP AREA BOUNDARY

TURTLE MOUNDS, TYP SEE HPL12

BEAVER ANALOG DAM TYP HPL11

FRE MAIN

GOVT LOT 4 SEC 21

FREEMAN ROAD

PUYALLUP SOUTH

22ND AVE NW

MATCHLINE SEE SHEET HPL07

FILE NAME	O:\proj\72016\15-06277-000\CAD\Dwg\Habitat\XL5105_PS_HPL_07.dgn					
TIME	3:09:51 PM					
DATE	8/16/2023					
PLOTTED BY	tpriscott					
DESIGNED BY	R. TAYLOR					
ENTERED BY	T. PRESCOTT					
CHECKED BY	K. FORESTER					
PROJ. ENGR.	C. SODERQUIST					
REGIONAL ADM.	J. WHITE					
		REVISION	DATE	BY		

REGION NO.	STATE	FED.AID PROJ. NO.
10	WASH	0167(059)
CONTRACT NO.		LOCATION NO.
22C529		XL5105

CONCEPTUAL DESIGN NOT FOR CONSTRUCTION

Washington State Department of Transportation

SR 167
I-5 TO SR 161
NEW EXPRESSWAY

HABITAT PLAN

PLAN SET NO. HPL07

SHEET OF SHEETS

PLANTING LEGEND:*

- FORESTED WETLAND (PFO) DECIDUOUS DOMINANT
- NATIVE VEGETATION PROTECTION ZONE
- EMERGENT WETLAND (PEM)
- SCRUB SHRUB WETLAND (PSS)
- AQUATIC VEGETATION
- DENSE HEDGEROW (RRP08)
- BEAVER DETERRENT ZONE (PSS)
- TURTLE MOUND

*NOTE: PLAN HATCH ROTATION VARIES PER SHEET DUE TO DIFFERENT ORIENTATIONS OF NORTH ARROW

LEGEND:

PROPOSED

- RIGHT OF WAY / LIMITED ACCESS
- 505 ROADWAY AND STREAM ALIGNMENT
- CUT / FILL LINE
- 11 CONTOURS (1FT)
- +14.0 SPOT ELEVATIONS
- RRP AREAS

NOTES:

1. REFER TO RRP10 FOR PLANT ZONE DESCRIPTIONS.
2. PRESERVE EXISTING NATIVE VEGETATION, NATIVE VEGETATION PROTECTION AREAS SHALL REMOVE INVASIVE AND NON-NATIVE WEEDY VEGETATION WHILE PROTECTING EXISTING NATIVE VEGETATION. BARE AREAS SHALL BE REVEGETATED WITH SPECIES APPROPRIATE FOR EACH AREA.

SCALE IN FEET
0 50 100

MATCHLINE SEE SHEET RRP06

MATCHLINE SEE SHEET RRP08

MATCHLINE SEE SHEET RRP08

MATCHLINE SEE SHEET RRP07

WS-1 LINE

WS-2 LINE

FRE_MAIN

TURTLE MOUND, TYP.

FOREST AND SHRUB MOUNDS TYP.

STAGE 2 MITIGATION AREA BOUNDARY

STAGE 2 MITIGATION AREA BOUNDARY

FREEMAN ROAD

PUYALLUP SOUTH

209A AVE NW

FILE NAME	O:\proj\Y2016\15-06277-000\CAD\Dwg\Landscape\XL5105_PS_LS_07.dgn						
TIME	7:09:04 PM						
DATE	8/15/2023						
PLOTTED BY	tprescott						
DESIGNED BY	R. TAYLOR						
ENTERED BY	T. PRESCOTT						
CHECKED BY	K. FORESTER						
PROJ. ENGR.	C. SODERQUIST						
REGIONAL ADM.	J. WHITE						
	REVISION	DATE	BY				

REGION NO. 10 | STATE WASH | FED.AID PROJ.NO. 0167(059) | CONTRACT NO. 22CS29 | CONTRACT NO. XL5105

CONCEPTUAL DESIGN NOT FOR CONSTRUCTION

Washington State Department of Transportation

SR 167
I-5 TO SR 161
NEW EXPRESSWAY

MITIGATION PLAN


PLAN SHT NO. RRP07 | SHEET | OF | SHEETS

Table 56g. Objectives and Performance Standards for the SR 167 RRP Wetland and Stream Mitigation – Freeman Road.

Mitigation Site	Goal	Objective	Monitoring Year	Performance Standards
14. Freeman Road	14.1. Restore stream channel	14.1.1 Restore a minimum of 1,292 linear feet of stream channel	Year 10	Combined length of stream channels (as measured in the thalweg) will meet or exceed 1,292 linear feet.
	14.2. Re-establish, rehabilitate, and enhance wetland	14.2.1 Re-establish and rehabilitate a minimum of 15.00 acres of wetland within the CGA • 11.27 acres wetland re-establishment • 3.61 acres wetland rehabilitation • 0.12 acre wetland enhancement	Years 5 and 10	The wetland area at the mitigation site will be delineated using current methods to ensure that the mitigation site contains the anticipated acreage.
		14.2.2 Establish wetland hydrology within re-established wetlands	Years 1, 3, 5, 7, 10	The soils in the wetlands will be saturated to the surface, or standing water will be present within 12 inches of the surface for at least 30 consecutive days during the growing season in years when rainfall meets or exceeds the 30-year average.
	14.3. Improve water quality, hydrologic, and habitat functions in re-established, rehabilitated, and enhanced wetlands	14.3.1 Establish native woody vegetation in wetland	Year 1	Stem density in planted scrub shrub and forested areas will meet or exceed 1,600 stems per acre. Planting density should exceed this metric to account for die-off.
			Year 3	Cover of native saplings, trees, and shrubs in planted forested and scrub-shrub wetland will be at least 20 percent.
			Year 5	Cover of native woody vegetation in planted forested and scrub-shrub wetland will be at least 35 percent.
			Year 7	Cover of native woody vegetation in planted forested and scrub-shrub wetland will be at least 50 percent.
			Year 10	Cover of native woody vegetation in planted forested and scrub-shrub wetland will be at least 75 percent.
			Year 10	A minimum of 10 species of native shrubs and trees will be present in the wetland by the end of the monitoring period.
		14.3.2 Control invasive species	All years	Washington State-listed or county-listed Class A weeds, Japanese knotweed, and purple loosestrife observed in any area of the mitigation site must be eradicated. All occurrences shall be immediately reported to the site manager and an eradication program will be initiated within 30 days of the report.
			Years 1 through 9	Non-designated Class B and Class C noxious weeds including reed canarygrass will not exceed 20 percent cover.
			Year 10	Non-designated Class B and Class C noxious weeds excluding reed canarygrass will not exceed 20 percent cover. Reed canarygrass will only exist as an understory component that does not outcompete native woody vegetation.
		14.3.3 Install fish and wildlife habitat structures	Year 0	Install a minimum of: • 8 perch trees • 10 brush piles • 5 nest boxes • 2 bat boxes on an existing mature tree
	14.4. Improve habitat functions in upland enhancement areas	14.4.1 Control invasive species	All years	Washington State-listed or county-listed Class A weeds, Japanese knotweed, and purple loosestrife observed in any area of the mitigation site must be eradicated. All occurrences shall be immediately reported to the site manager and an eradication program will be initiated within 30 days of the report.
			Years 1 through 9	Non-designated Class B and Class C noxious weeds including reed canarygrass will not exceed 20 percent cover.
			Year 10	Non-designated Class B and Class C noxious weeds excluding reed canarygrass will not exceed 20 percent cover. Reed canarygrass will only exist as an understory component that does not outcompete native woody vegetation.

Table 56g. Objectives and Performance Standards for the SR 167 RRP Wetland and Stream Mitigation – Freeman Road.				
Mitigation Site	**Goal**	**Objective**	**Monitoring Year**	**Performance Standards**
14. Freeman Road	14.4 (continued) Improve habitat functions in upland areas	14.4.2 Enhance native understory vegetation	Year 0	The contractor will provide GPS locations of any underplanted areas.
			Year 1	Planted vegetation will achieve 100 percent survival 1 year after the site is planted. If all dead woody plantings are replaced, the performance measure will be met.
			Years 2 and 3	Planted vegetation will exhibit 80 percent survival within 2 to 3 years after installation.
		14.4.3 Establish native trees and shrubs in upland	Year 1	Stem density in planted scrub shrub and forested areas will meet or exceed 1,600 stems per acre. Planting density should exceed this metric to account for die off.
			Year 3	Cover of native saplings, trees, and shrubs in planted forested and scrub-shrub wetland will be at least 20 percent.
			Year 5	Cover of native woody vegetation in planted forested and scrub-shrub wetland will be at least 35 percent.
			Year 7	Cover of native woody vegetation in planted forested and scrub-shrub wetland will be at least 50 percent.
			Year 10	Cover of native woody vegetation in planted forested and scrub-shrub wetland will be at least 75 percent.
			Year 10	A minimum of 10 species of native shrubs and trees will be present in the wetland by the end of the monitoring period.

Appendix E
On-Site Mitigation Design Plans

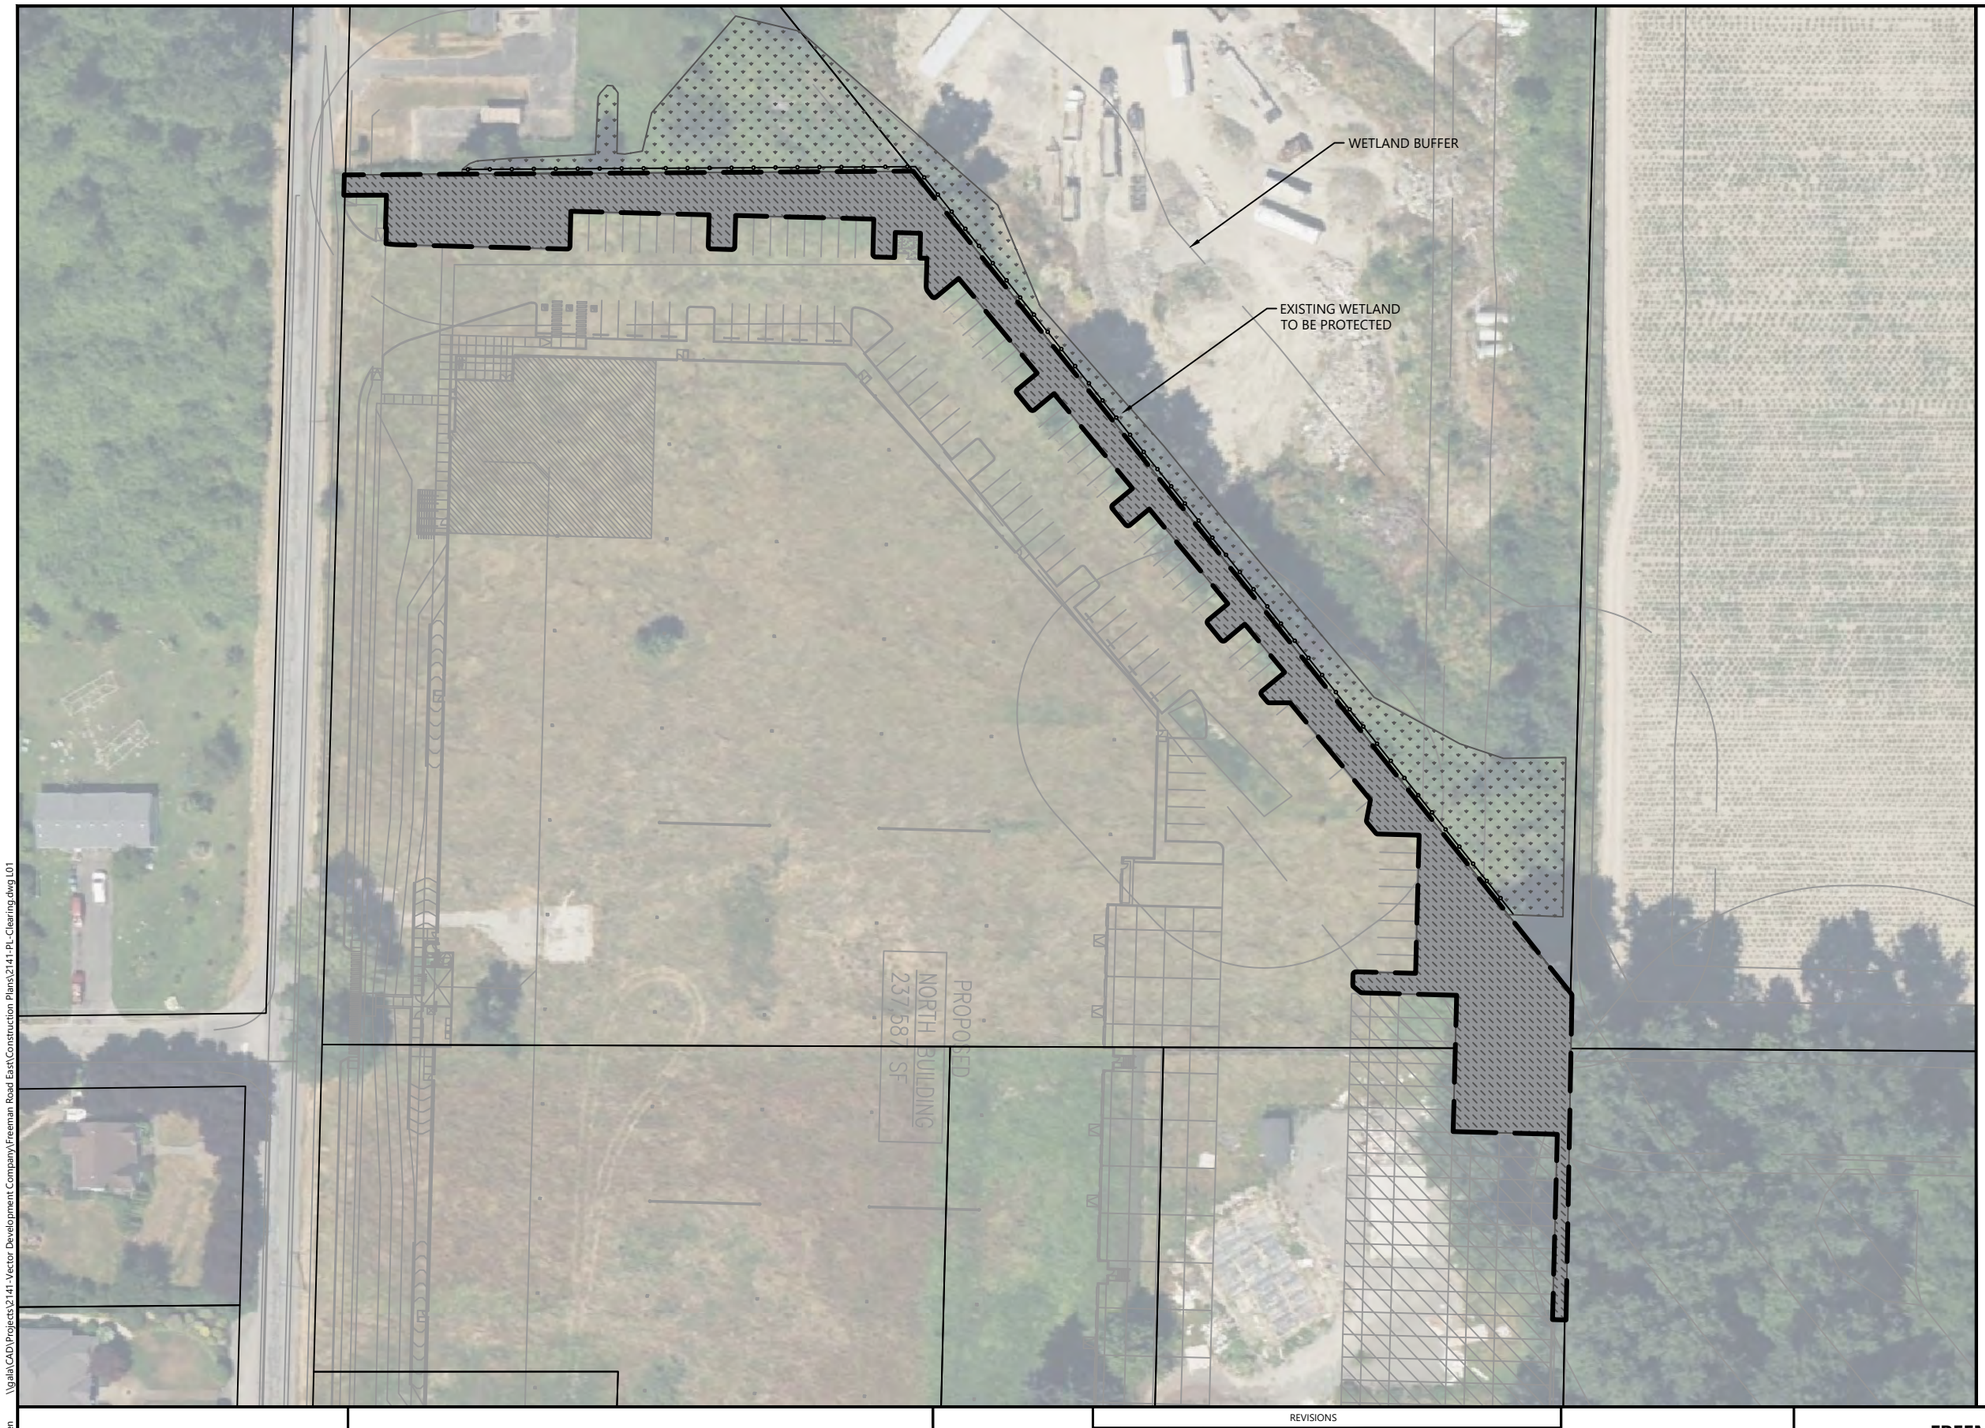

LEGEND:

- LIMIT OF WORK
- PARCEL (GIS, PIERCE COUNTY)
- CLEAR AND GRUB
- EXISTING WETLAND
- SILT FENCE

CLEARING NOTES:

1. REMOVE INVASIVE SPECIES WITHIN CLEAR AND GRUB AREAS. INVASIVE SPECIES MUST BE REMOVED BEFORE PROPOSED PLANTS CAN BE INSTALLED.
2. NO WORK SHALL OCCUR IN WITHIN WETLAND.
3. REFER TO PLANTING GUIDELINES.

NORTH

0 40 80

SCALE IN FEET

NOTES:

1. HORIZONTAL DATUM: WASHINGTON STATE PLANE SOUTH ZONE, NAD83, U.S. SURVEY FEET
2. AERIAL: BING MAPS
3. SITE PLAN SOURCE: SYNTHESIS PLLC
3. ENGINEERING SOURCE: BARGHAUSEN CONSULTING ENGINEERS, INC

PLAN INTENDED TO BE VIEWED IN COLOR. ADJACENT BLOCK IS 'BLUE'

ONE INCH AT FULL SIZE. IF NOT ONE INCH SCALE ACCORDINGLY

\\gala\CAD\Projects\2141-Vector Development Company\Freeman Road East\Construction Plans\2141-PL-Clearing.dwg L01

Dec 18, 2024 8:39pm Randersen

ANCHOR QEA

VECTOR DEVELOPMENT COMPANY

REVISIONS				
REV	DATE	BY	APP'D	DESCRIPTION


DESIGNED BY: R. ANDERSEN
DRAWN BY: R. ANDERSEN
CHECKED BY: A. SPOONER
APPROVED BY: A. SPOONER
SCALE: AS NOTED
DATE: DECEMBER 2024

FREEMAN ROAD EAST
PUYALLUP, WA

CLEARING PLAN

L01

SHEET # 1 OF 5

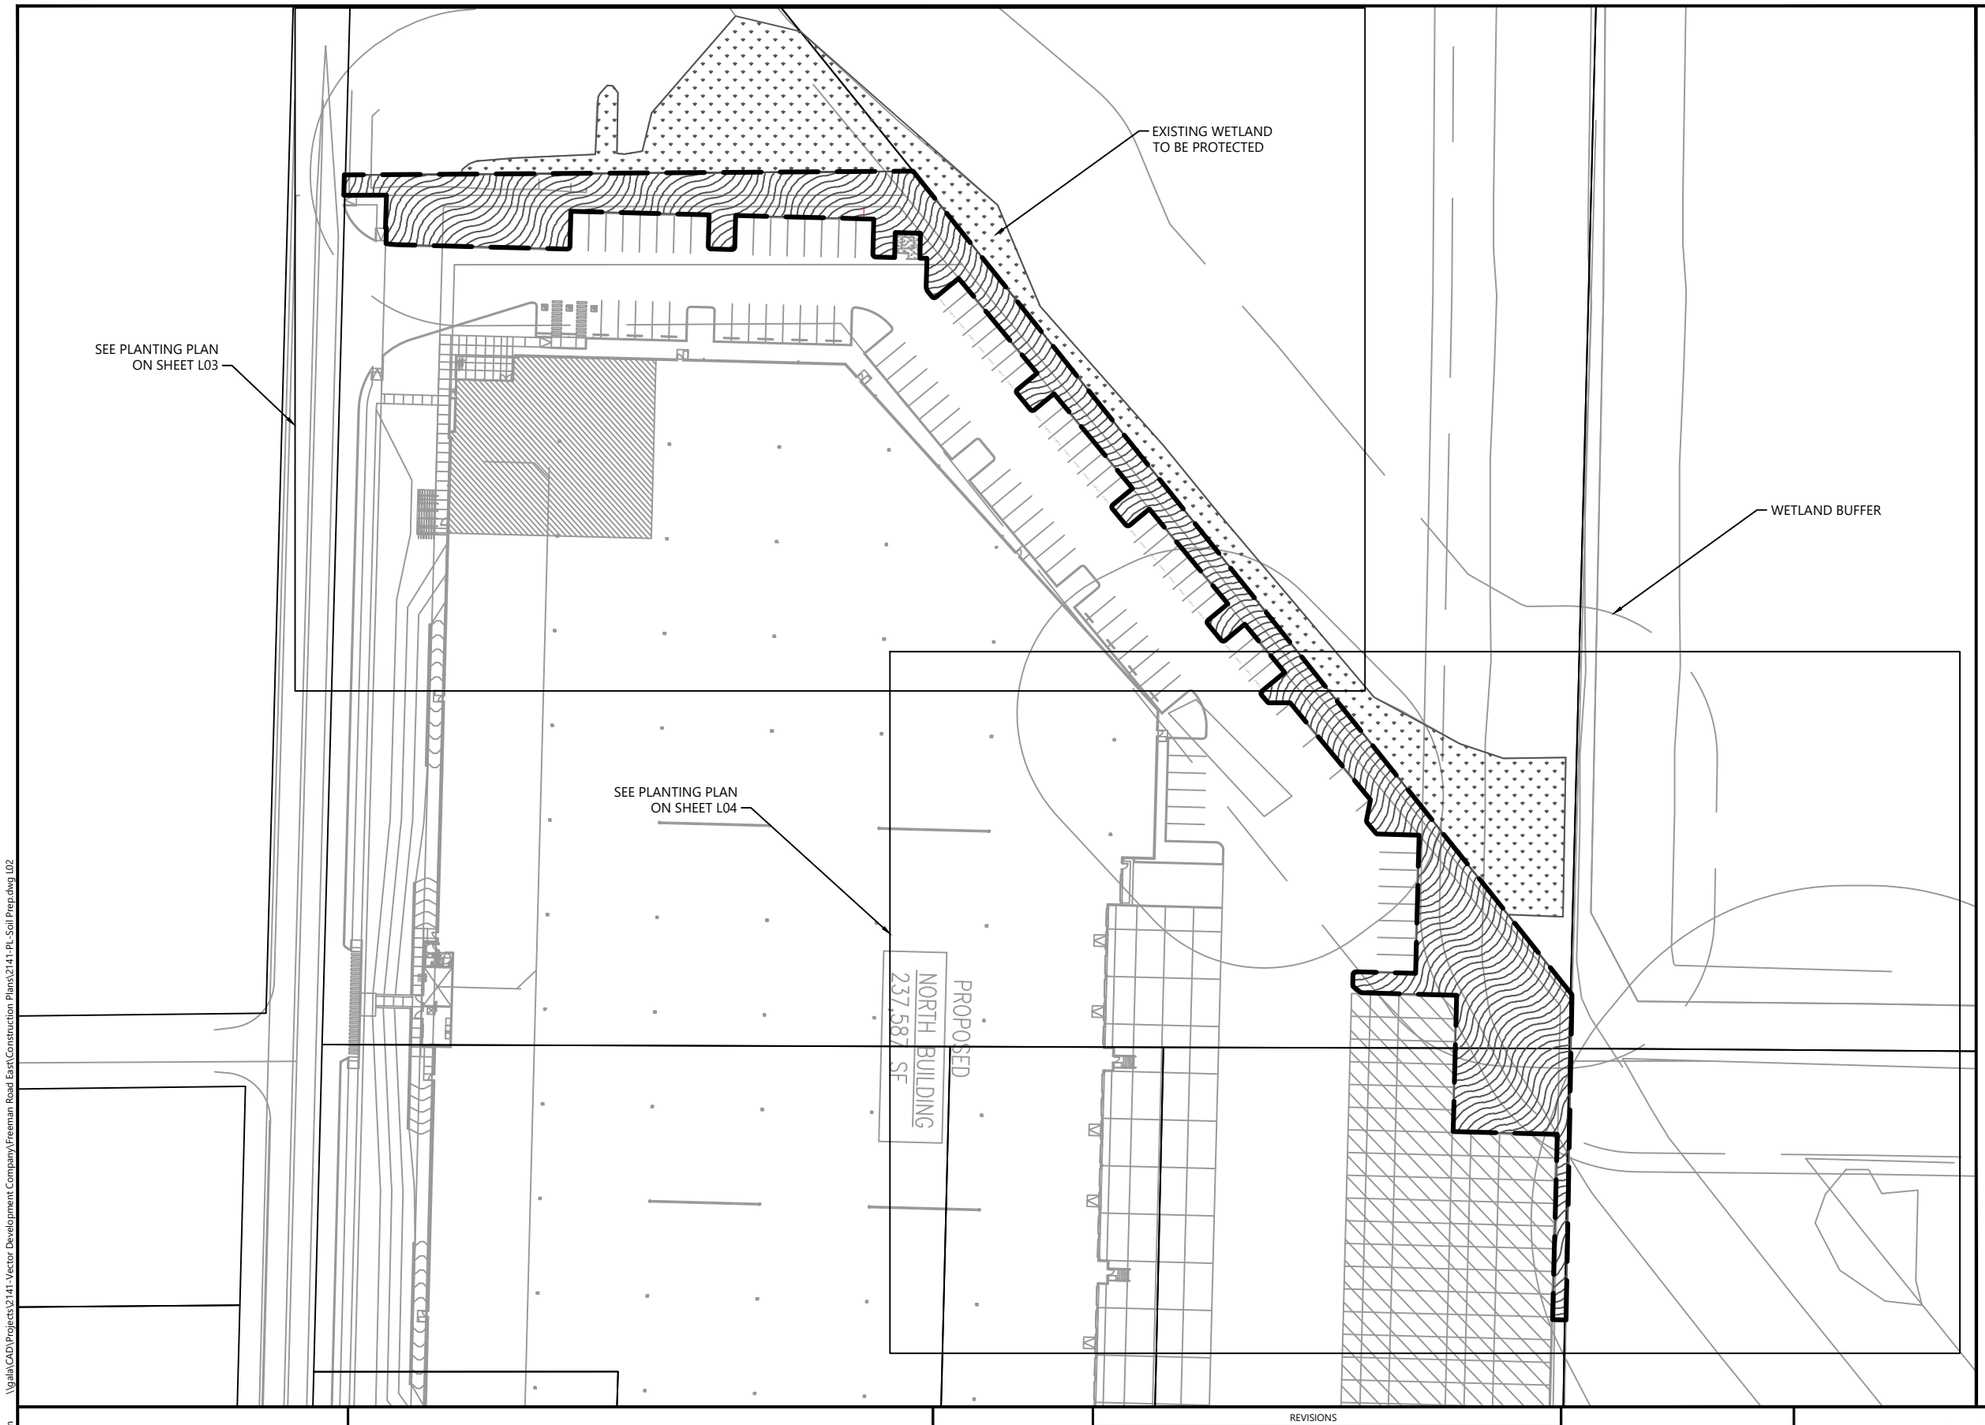

LEGEND:

- LIMIT OF WORK
- PARCEL (GIS, PIERCE COUNTY)
- EXISTING WETLAND
- 12' DEPTH PLANTING SOIL

CLEARING NOTES:

1. REMOVE INVASIVE SPECIES WITHIN CLEAR AND GRUB AREAS. INVASIVE SPECIES MUST BE REMOVED BEFORE PROPOSED PLANTS CAN BE INSTALLED.
2. NO WORK SHALL OCCUR IN WITHIN WETLAND.
3. REFER TO PLANTING GUIDELINES.

NORTH

0 40 80

SCALE IN FEET

NOTES:

1. HORIZONTAL DATUM: WASHINGTON STATE PLANE SOUTH ZONE, NAD83, U.S. SURVEY FEET
2. AERIAL: BING MAPS
3. SITE PLAN SOURCE: SYNTHESIS PLLC
3. ENGINEERING SOURCE: BARGHAUSEN CONSULTING ENGINEERS, INC

PLAN INTENDED TO BE VIEWED IN COLOR. ADJACENT BLOCK IS "BLUE"

ONE INCH AT FULL SIZE. IF NOT ONE INCH SCALE ACCORDINGLY

ANCHOR QEA

VECTOR DEVELOPMENT COMPANY

REVISIONS

REV	DATE	BY	APP'D	DESCRIPTION

DESIGNED BY: R. ANDERSEN
DRAWN BY: R. ANDERSEN
CHECKED BY: A. SPOONER
APPROVED BY: A. SPOONER
SCALE: AS NOTED
DATE: DECEMBER 2024


FREEMAN ROAD EAST
PUYALLUP, WA

SOIL PREPARATION AND PLANTING KEY PLAN

L02

SHEET # 2 OF 5

Dec 18, 2024 8:39pm Randersen \\gala\CAD\Projects\2141-Vector Development Company\Freeman Road East\Construction Plans\2141-PL-Soil Prep.dwg L02

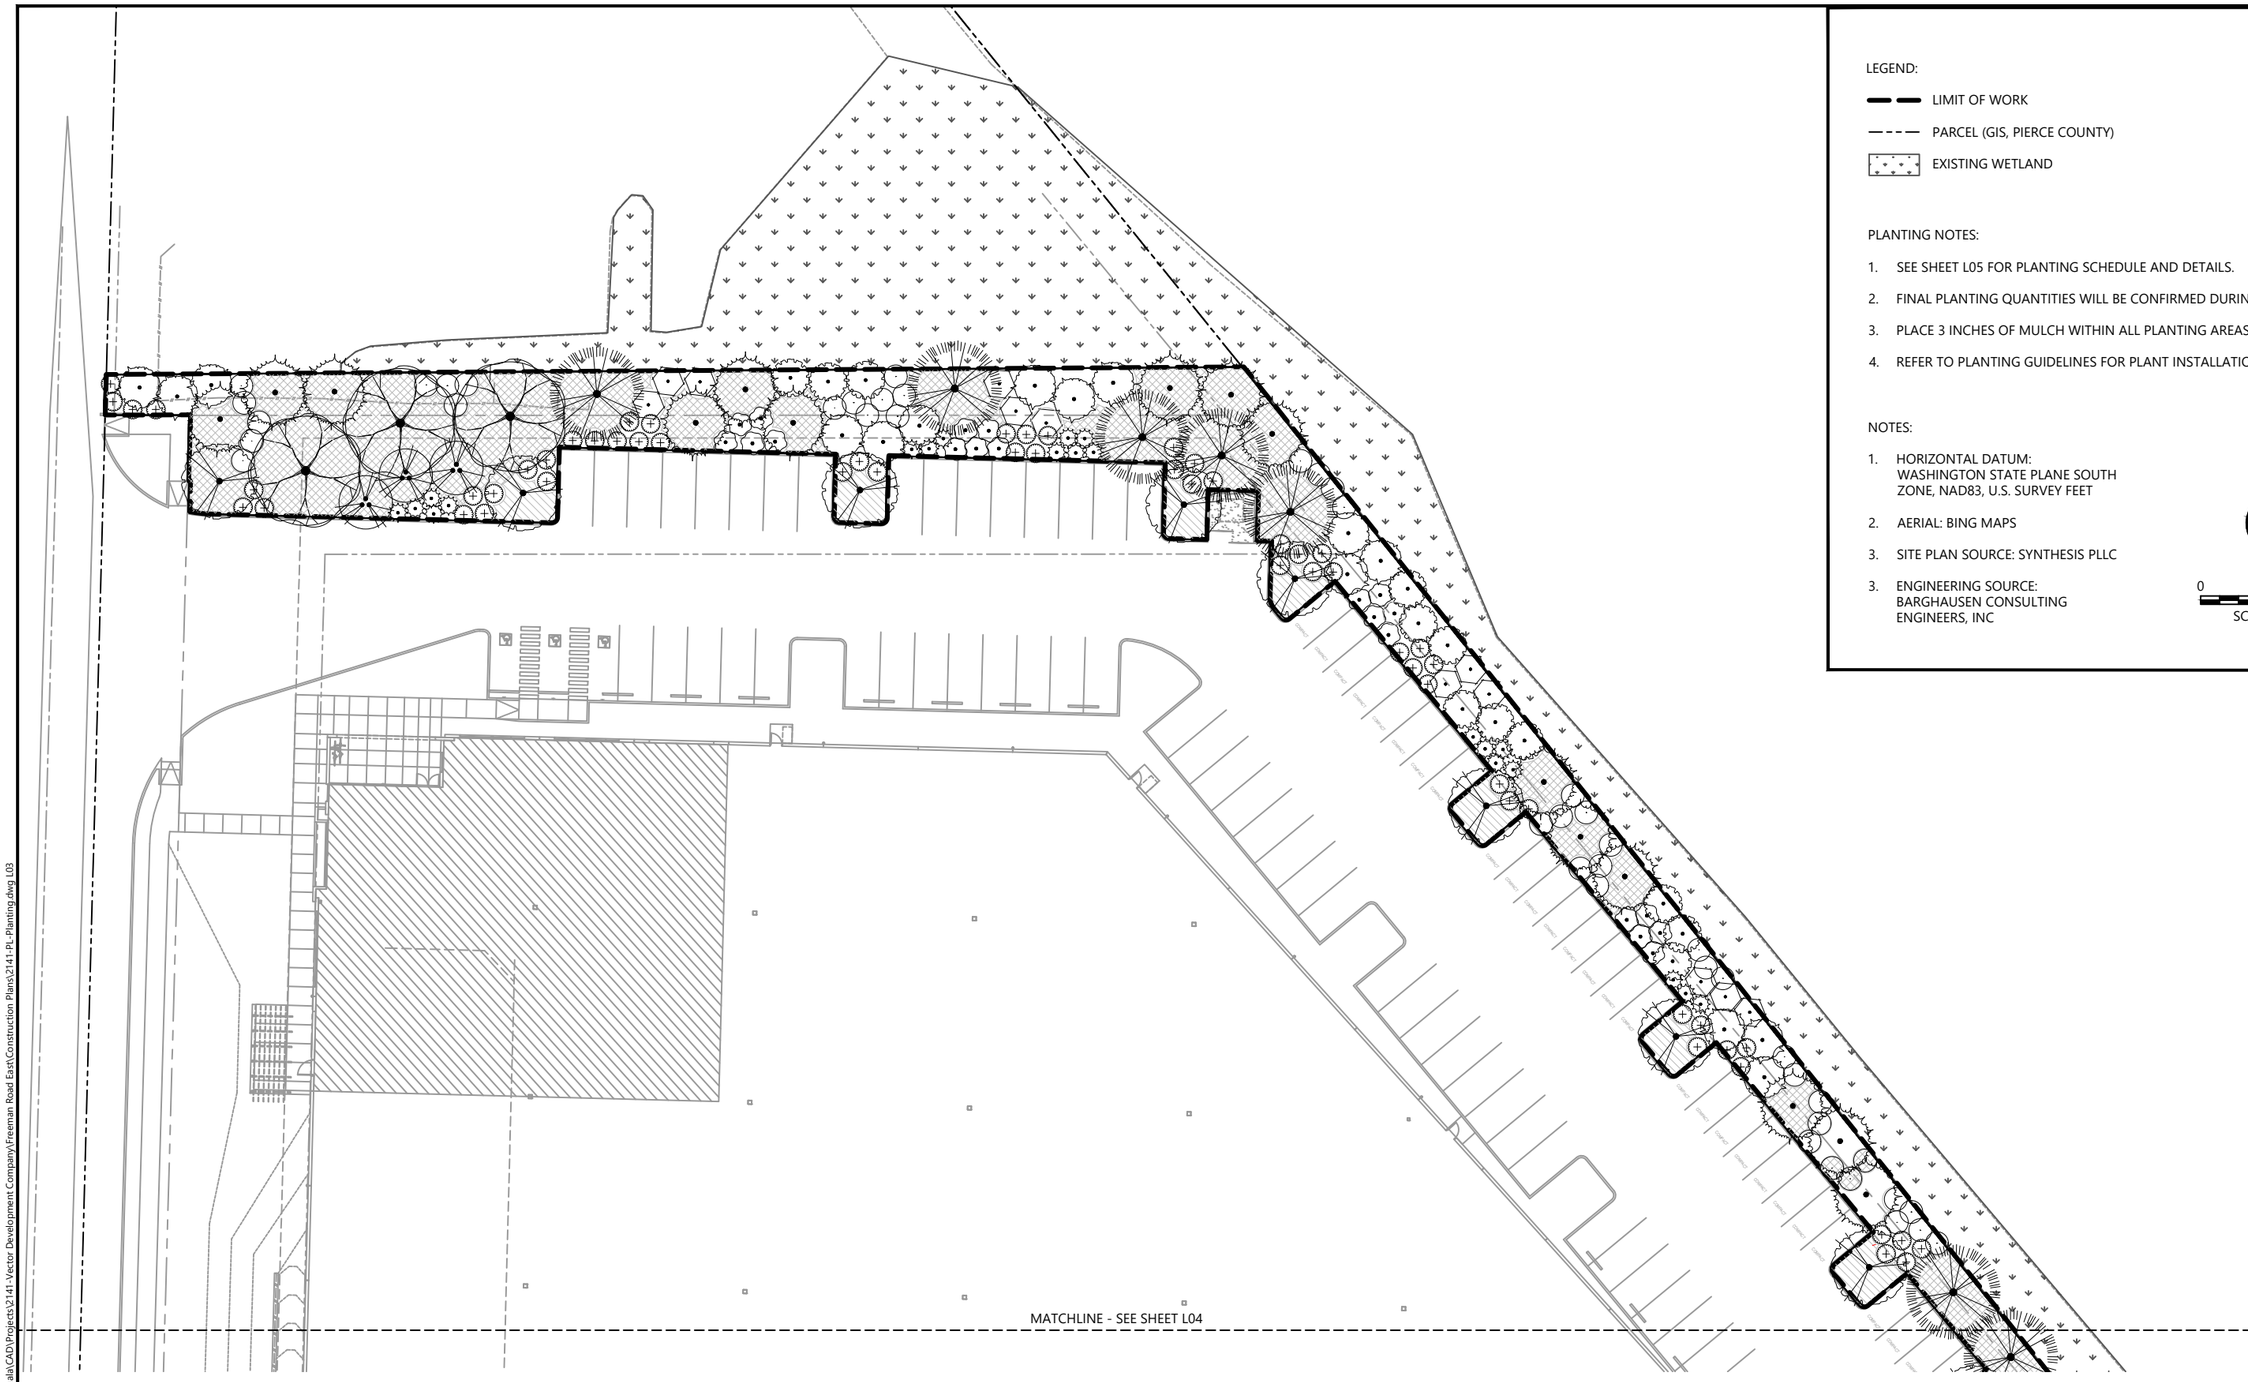

LEGEND:

- LIMIT OF WORK
- PARCEL (GIS, PIERCE COUNTY)
- EXISTING WETLAND

PLANTING NOTES:

1. SEE SHEET L05 FOR PLANTING SCHEDULE AND DETAILS.
2. FINAL PLANTING QUANTITIES WILL BE CONFIRMED DURING FINAL DESIGN.
3. PLACE 3 INCHES OF MULCH WITHIN ALL PLANTING AREAS.
4. REFER TO PLANTING GUIDELINES FOR PLANT INSTALLATION.

NOTES:

1. HORIZONTAL DATUM: WASHINGTON STATE PLANE SOUTH ZONE, NAD83, U.S. SURVEY FEET
2. AERIAL: BING MAPS
3. SITE PLAN SOURCE: SYNTHESIS PLLC
3. ENGINEERING SOURCE: BARGHAUSEN CONSULTING ENGINEERS, INC

NORTH

0 10 20

SCALE IN FEET

PLAN INTENDED TO BE VIEWED IN COLOR. ADJACENT BLOCK IS "BLUE"

ONE INCH AT FULL SIZE, IF NOT ONE INCH SCALE ACCORDINGLY

\\galla\CAD\Projects\2141-Vector Development Company\Freeman Road East\Construction Plans\2141-PL Planting.dwg L03

Dec 18, 2024 8:39pm Randersen

ANCHOR QEA

VECTOR DEVELOPMENT COMPANY

REVISIONS

REV	DATE	BY	APP'D	DESCRIPTION

DESIGNED BY: R. ANDERSEN
DRAWN BY: R. ANDERSEN
CHECKED BY: A. SPOONER
APPROVED BY: A. SPOONER
SCALE: AS NOTED
DATE: DECEMBER 2024

FREEMAN ROAD EAST
PUYALLUP, WA

PLANTNG PLAN (1 OF 2)

L03

SHEET # 3 OF 5

MATCHLINE - SEE SHEET L03

LEGEND:

- LIMIT OF WORK
- PARCEL (GIS, PIERCE COUNTY)
- EXISTING WETLAND

PLANTING NOTES:

1. SEE SHEET L05 FOR PLANTING SCHEDULE AND DETAILS.
2. FINAL PLANTING QUANTITIES WILL BE CONFIRMED DURING FINAL DESIGN.
3. PLACE 3 INCHES OF MULCH WITHIN ALL PLANTING AREAS.
4. REFER TO PLANTING GUIDELINES FOR PLANT INSTALLATION.

NOTES:

1. HORIZONTAL DATUM:
   WASHINGTON STATE PLANE SOUTH
   ZONE, NAD83, U.S. SURVEY FEET
2. AERIAL: BING MAPS
3. SITE PLAN SOURCE: SYNTHESIS PLLC
3. ENGINEERING SOURCE:
   BARGHAUSEN CONSULTING
   ENGINEERS, INC

NORTH

0 10 20

SCALE IN FEET

PLAN INTENDED TO BE VIEWED IN COLOR. ADJACENT BLOCK IS "BLUE"

ONE INCH AT FULL SIZE, IF NOT ONE INCH SCALE ACCORDINGLY

\\gala\CAD\Projects\2141 - Vector Development Company\Freeman Road East\Construction Plans\2141-PL-Planting.dwg L04

Dec 18, 2024 8:39pm Randersen

ANCHOR QEA

VECTOR DEVELOPMENT COMPANY

REVISIONS				
REV	DATE	BY	APP'D	DESCRIPTION

DESIGNED BY: R. ANDERSEN
DRAWN BY: R. ANDERSEN
CHECKED BY: A. SPOONER
APPROVED BY: A. SPOONER
SCALE: AS NOTED
DATE: DECEMBER 2024

FREEMAN ROAD EAST
PUYALLUP, WA


PLANTING PLAN (2 OF 2)

L04

SHEET # 4 OF 5

PLANTING SCHEDULE


SYMBOL	BOTANICAL / COMMON NAME	SIZE	SPACING	QTY	DETAIL
TREES					
	Acer circinatum / Vine Maple	1 gal.	As shown	9	1 / L05
	Cornus nuttallii / Pacific Dogwood	5 gal.	As shown	6	1 / L05
	Pinus contorta / Shore Pine	2 gal	As shown	12	2 / L05
	Pseudotsuga menziesii / Douglas Fir	2 gal	As shown	24	2 / L05
	Rhamnus purshiana / Cascara	2 gal	As shown	11	1 / L05
SHRUBS					
	Arctostaphylos columbiana / Hairy Manzanita	1 gal.	4' o.c.	37	
	Cornus sericea / Red Twig Dogwood	1 gal.	5' o.c.	40	
	Corylus cornuta / Western Hazelnut	1 gal.	8' o.c.	24	
	Myrica californica / Pacific Wax Myrtle	1 gal.	10' o.c.	29	3 / L05
	Rosa woodsii / Mountain Rose	1 gal.	4' o.c.	35	
	Sorbus sitchensis / Western Mountain Ash	1 gal.	6' o.c.	18	
	Symphoricarpos albus / Common White Snowberry	1 gal.	5' o.c.	95	
GROUND COVERS					
	Arctostaphylos uva-ursi / Kinnikinnick	4"	36" o.c.	284	4 / L05
	Mahonia nervosa / Oregon Grape	4"	36" o.c.	1,280	

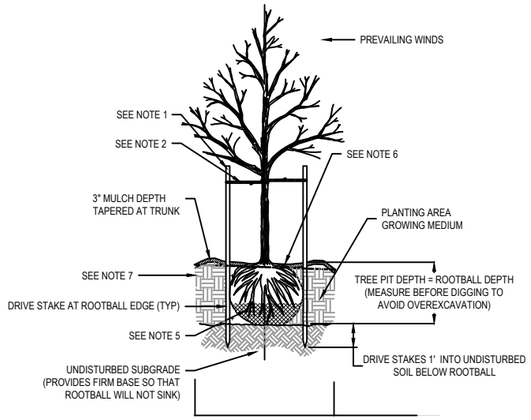


NOTES:

1. STAKE TREES WITH (2) 2" DIAMETER (8' LENGTH) LODGEPOLE PINE OR DOUGLAS FIR STAKES.
2. CHAINLOCK TREE TIE. LOOP EACH TIE AROUND TREE LOOSELY TO PROVIDE 1" SLACK FOR DIAMETER GROWTH.
3. ONE STAKE PER TREE ON WINDWARD SIDE.
4. SECOND STAKE ON LEEWARD SIDE.
5. REMOVE ALL WIRE AND STRING. REMOVE TOP 2/3 OF BURLAP.
6. SHAPE SOIL TO PROVIDE 3' DIAMETER OR ROOTBALL DIAMETER, WHICHEVER IS GREATER, WATERING RING.
7. ROUGHEN SIDES OF PLANTING HOLE MAXIMIZE EXCAVATED AREA WITHOUT UNDERMINING ADJACENT IMPROVEMENTS.
8. MULCH AREA TO BE CLEAR OF GRASS, WEEDS, ETC. TO REDUCE COMPETITION WITH TREE ROOTS.

1 / L03 **DECIDUOUS TREE PLANTING**
SCALE:NTS

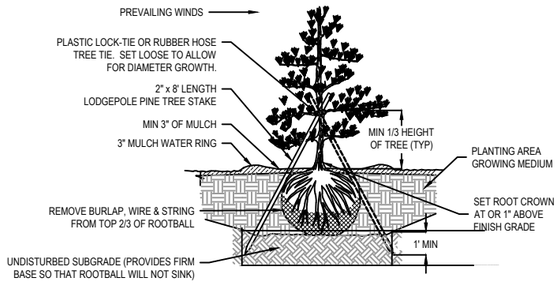


2 / L03 **CONIFEROUS TREE PLANTING**
SCALE:NTS

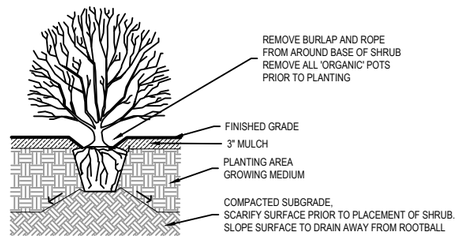

NOTES:

1. SHRUB TO BE PLANTED WITH ELEVATION OF TOP OF ROOTBALL OR POT LEVEL WITH FINISH GRADE OF GROWING MEDIUM.
2. COMPOSTED BARK MULCH AT TO BE KEPT AT LEAST 50mm AWAY FROM STEMS OF SHRUB.
3. PLANTING PIT MUST BE FREE DRAINING

3 / L03 **SHRUB PLANTING**
SCALE:NTS

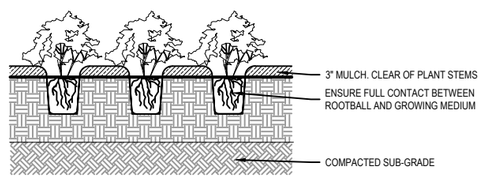

NOTES:

1. PLANT TO BE PLANTED WITH TOP OF ROOTBALL LEVEL WITH FINISH GRADE.
2. MULCH TO BE KEPT AT LEAST 2" AWAY FROM STEMS.
3. PRUNE ANY BROKEN OR DAMAGED BRANCHES AND DOUBLE LEADERS USING APPROVED PRUNING TOOLS AND STANDARD I.S.A. PRUNING PRACTICES. SEE SPECIFICATIONS.
4. A REPRESENTATIVE AREA OF EACH PLANT SPECIES IS TO BE LAID OUT AND APPROVED BY CONTRACT ADMINSTRATOR PRIOR TO PLANTING

4 / L03 **GROUNDCOVER PLANTING**
SCALE:NTS

PLAN INTENDED TO BE VIEWED IN COLOR. ADJACENT BLOCK IS "BLUE"

ONE INCH AT FULL SIZE, IF NOT ONE INCH SCALE ACCORDINGLY

ANCHOR QEA

VECTOR DEVELOPMENT COMPANY

REVISIONS				
REV	DATE	BY	APP'D	DESCRIPTION

DESIGNED BY: R. ANDERSEN
DRAWN BY: R. ANDERSEN
CHECKED BY: A. SPOONER
APPROVED BY: A. SPOONER
SCALE: AS NOTED
DATE: DECEMBER 2024

FREEMAN ROAD EAST
PUYALLUP, WA

PLANTING SCHEDULE AND DETAILS

L05

SHEET # 4 OF 5

Dec 18, 2024 8:39pm Randersen
\\gala\CAD\Projects\2141-Vector Development Company\Freeman Road East\Construction Plans\2141-PL-Planting Details.dwg L05

Tab 7.0

7.0 OTHER PERMITS

7.0 OTHER PERMITS

Other permits for this project site include:

- NPDES General Permit from the Department of Ecology
- Site Development Permit from the City of Puyallup
- Grade and Fill Permit from the City of Puyallup
- Right of Way Permits from the City of Puyallup and Fife

Tab 8.0

8.0 CONSTRUCTION STORMWATER POLLUTION PREVENTION PLAN

A complete Construction Stormwater Pollution Prevention Plan is included within this section.

Construction Stormwater General Permit (CSWGP)

Stormwater Pollution Prevention Plan (SWPPP)

for

Freeman Logistics

Prepared for:

Department of Ecology

Southwest Regional Office

Permittee / Owner	Developer	Operator / Contractor
Vector Development Company	Vector Development Company	TBD

East of Freeman Road, between 48th St E and N Levee Rd

Certified Erosion and Sediment Control Lead (CESCL)

Name	Organization	Contact Phone Number
TBD	TBD	TBD

SWPPP Prepared By

Name	Organization	Contact Phone Number
Jason McArdel	Barghausen Consulting Engineers, Inc.	425-251-6222

SWPPP Preparation Date

12/23/2024

Project Construction Dates

Activity / Phase	Start Date	End Date
TBD	TBD	TBD

Table of Contents

List of Acronyms and Abbreviations 4
Project Information (1.0) 5
Existing Conditions (1.1) 5
Proposed Construction Activities (1.2) 6
Construction Stormwater Best Management Practices (BMPs) (2.0) 7
The 12 Elements (2.1) 7
Element 1: Preserve Vegetation / Mark Clearing Limits (2.1.1) 7
Element 2: Establish Construction Access (2.1.2) 8
Element 3: Control Flow Rates (2.1.3) 9
Element 4: Install Sediment Controls (2.1.4) 10
Element 5: Stabilize Soils (2.1.5) 11
Element 6: Protect Slopes (2.1.6) 13
Element 7: Protect Drain Inlets (2.1.7) 14
Element 8: Stabilize Channels and Outlets (2.1.8) 15
Element 9: Control Pollutants (2.1.9) 16
Element 10: Control Dewatering (2.1.10) 22
Element 11: Maintain BMPs (2.1.11) 23
Element 12: Manage the Project (2.1.12) 24
Element 13: Protect Low Impact Development (LID) BMPs (2.1.13) 27
Pollution Prevention Team (3.0) 29
Monitoring and Sampling Requirements (4.0) 30
Site Inspection (4.1) 30
Stormwater Quality Sampling (4.2) 30
Turbidity Sampling (4.2.1) 30
pH Sampling (4.2.2) 32
Discharges to 303(d) or Total Maximum Daily Load (TMDL) Waterbodies (5.0) 33
303(d) Listed Waterbodies (5.1) 33
TMDL Waterbodies (5.2) 33
Reporting and Record Keeping (6.0) 34

Record Keeping (6.1) 34
Site Log Book (6.1.1) 34
Records Retention (6.1.2) 34
Updating the SWPPP (6.1.3) 34
Reporting (6.2) 35
Discharge Monitoring Reports (6.2.1) 35
Notification of Noncompliance (6.2.2) 35

Appendix/Glossary

A. Site Map
B. BMP Detail
C. Correspondence
D. Site Inspection Form
E. Construction Stormwater General Permit (CSWGP)
F. 303(d) List Waterbodies / TMDL Waterbodies Information
G. Contaminated Site Information
H. Engineering Calculations

List of Acronyms and Abbreviations

Acronym / Abbreviation	Explanation
303(d)	Section of the Clean Water Act pertaining to Impaired Waterbodies
BFO	Bellingham Field Office of the Department of Ecology
BMP(s)	Best Management Practice(s)
CESCL	Certified Erosion and Sediment Control Lead
CO_2	Carbon Dioxide
CRO	Central Regional Office of the Department of Ecology
CSWGP	Construction Stormwater General Permit
CWA	Clean Water Act
DMR	Discharge Monitoring Report
DO	Dissolved Oxygen
Ecology	Washington State Department of Ecology
EPA	United States Environmental Protection Agency
ERO	Eastern Regional Office of the Department of Ecology
ERTS	Environmental Report Tracking System
ESC	Erosion and Sediment Control
GULD	General Use Level Designation
NPDES	National Pollutant Discharge Elimination System
NTU	Nephelometric Turbidity Units
NWRO	Northwest Regional Office of the Department of Ecology
pH	Power of Hydrogen
RCW	Revised Code of Washington
SPCC	Spill Prevention, Control, and Countermeasure
su	Standard Units
SWMMEW	Stormwater Management Manual for Eastern Washington
SWMMWW	Stormwater Management Manual for Western Washington
SWPPP	Stormwater Pollution Prevention Plan
TESC	Temporary Erosion and Sediment Control
SWRO	Southwest Regional Office of the Department of Ecology
TMDL	Total Maximum Daily Load
VFO	Vancouver Field Office of the Department of Ecology
WAC	Washington Administrative Code
WSDOT	Washington Department of Transportation
WWHM	Western Washington Hydrology Model

Project Information (1.0)

Project/Site Name: Freeman Logistics
Street/Location: East of Freeman Road between 48th St E and N Levee Rd
City: Puyallup State: WA Zip code: 98037
Subdivision: Pierce County
Receiving waterbody: Puyallup River

Existing Conditions (1.1)

Total acreage (including support activities such as off-site equipment staging yards, material storage areas, borrow areas).

Total acreage: 24.05 acres

Disturbed acreage: 25.59 acres

Existing structures: Existing structures have been demolished per a separate work order.

Landscape topography: Generally flat

Existing drainage patterns: Sheet flows to the northeast, eventually converging with an existing open channel system and converging with the Oxbow Lake approximately 1.25 miles downstream of the project site.

Existing Vegetation: Scattered vegetation and trees.

Critical Areas: No critical areas exist on the project site.

List of known impairments for 303(d) listed or Total Maximum Daily Load (TMDL) for the receiving waterbody:

Table 1 includes a list of suspected and/or known contaminants associated with the construction activity.

Table 1 – Summary of Site Pollutant Constituents

Constituent (Pollutant)	Location	Depth	Concentration
[Insert Text]	[Insert Text]	[Insert Text]	[Insert Text]

Proposed Construction Activities (1.2)

Description of site development (example: subdivision):
Commercial warehouses with parking and frontage improvements.

Description of construction activities (example: site preparation, demolition, excavation):
Final improvements of proposed buildings and associated parking.

Description of site drainage including flow from and onto adjacent properties. Must be consistent with Site Map in Appendix A:
There are no drainage devices onsite and all drainage consists of sheet flow and shallow concentrated flow. The outlet point for the majority of runoff from the site is a 12" concrete culvert which crosses under Freeman Road at the northwest property corner.

Description of final stabilization (example: extent of revegetation, paving, landscaping):
Buildings upright construction, pavement and associated landscaping.

Contaminated Site Information:
Proposed activities regarding contaminated soils or groundwater (example: on-site treatment system, authorized sanitary sewer discharge):
Dewatering might be necessary during some utility excavations. No contaminated soils are known to exist near the project site.

Construction Stormwater Best Management Practices (BMPs) (2.0)

The SWPPP is a living document reflecting current conditions and changes throughout the life of the project. These changes may be informal (i.e. hand-written notes and deletions). Update the SWPPP when the CESCL has noted a deficiency in BMPs or deviation from original design.

The 12 Elements (2.1)

Element 1: Preserve Vegetation / Mark Clearing Limits (2.1.1)

To protect adjacent properties and to reduce the area of soil exposed to construction, the limits of construction will be clearly marked before land-disturbing activities begin. Trees that are to be preserved, as well as all sensitive areas and their buffers, shall be clearly delineated, both in the field and on the plans. In general, natural vegetation and native topsoil shall be retained in an undisturbed state to the maximum extent possible. The BMP relevant to marking the clearing limits that will be applied for this project include the following:

List and describe BMPs:

- High Visibility Fence (BMP C103)

  Install colored orange fence to protect areas that are not to be disturbed, and mark trees to be preserved.

- Silt Fence (BMP C233)

  Silt fencing shall be used to control sediment flow offsite or into Gardiner Creek throughout the construction process.

Installation Schedules: All BMPs to preserve vegetation and mark clearing limits are to be installed prior to clearing and grading.

Inspection and Maintenance plan: All fencing is to be inspected at the end of each day's work and repaired if found to be noncompliant with BMP specifications.

Responsible Staff: Certified Erosion and Sediment Control Lead.

Element 2: Establish Construction Access (2.1.2)

Construction access or activities occurring on unpaved areas shall be minimized, yet where necessary, access points shall be stabilized to minimize the tracking of sediment onto public roads. Street sweeping and street cleaning shall be employed where necessary to prevent sediment from entering state waters. All wash wastewater shall be controlled onsite. The specific BMPs related to establishing construction access that will be used on this project are as follows:

List and describe BMPs:

- Stabilized Construction Entrance (BMP C105)

  A stabilized construction entrance will be used to minimize the amount of sediment transported off site onto the existing roadway by construction traffic.

- Construction Road/Parking Area Stabilization (BMP C107)

  Proposed roads shall be stabilized immediately after grading to reduce erosion by construction traffic or surface water runoff. During vertical construction, apply quarry spall base on drive approaches for buildings lot/pad access or in other high traffic areas such as material equipment storage and concrete washout areas.

- Concrete Washout Area (BMP C154)

  Conduct washout off-site or perform on-site concrete washout in a designated area. This is done to prevent pollutants from entering surface or ground water.

If sediment is tracked off site, clean the affected roadway thoroughly at the end of each day or more frequently, as necessary. Remove sediment from roads by shoveling, sweeping, or pickup and transport of the sediment to a controlled sediment disposal area.

Conduct street washing only after sediment removal in accordance with special condition S9.D.2.d. Control street wash wastewater by pumping back on site or otherwise preventing it from discharging off site into catch basins, stormwater conveyance systems, creek, or rivers that connect to waters of the State.

Installation Schedules: Installation schedule to be determined by the General Contractor.

Inspection and Maintenance plan: Inspection and maintenance is to take place at the end of each day's work.

Responsible Staff: Certified Erosion and Sediment Control Lead.

Element 3: Control Flow Rates (2.1.3)

In order to protect the properties and waterways downstream of the project site, stormwater discharges from the site will be controlled. The Specific BMPs for the flow control that shall be used on this project include the following:

Will you construct stormwater retention and/or detention facilities?
☒ Yes ☐ No

Will you use permanent infiltration ponds or other low impact development (example: rain gardens, bio-retention, porous pavement) to control flow during construction?
☐ Yes ☒ No

List and describe BMPs:

- Sediment Pond (BMP C241)

The project site is located west of the Cascade Mountain Crest. As a result, the project must comply with the Minimum Requirement 7 (Ecology 2012). Minimum Requirement 7 states that projects must provide flow control to reduce the impacts of stormwater runoff from impervious surfaces and land cover conversions.

Essentially, discharge rates of stormwater from the site will be controlled where increases in impervious area or soil compaction during construction could lead to downstream erosion, or where necessary to meet local agency stormwater discharge requirements (e.g. discharge to combined sewer systems).

Installation Schedules: Installation schedule to be determined by the General Contractor.

Inspection and Maintenance plan: Inspection and maintenance is to take place at the end of each day's work.

Responsible Staff: Certified Erosion and Sediment Control Lead.

Element 4: Install Sediment Controls (2.1.4)

All stormwater runoff from disturbed areas shall pass through an appropriate sediment removal BMP before leaving the construction site or prior to being discharge to a detention facility. The specific BMPs to be used for controlling sediment on this project are as follows:

List and describe BMPs:

- Silt Fence (BMP C233)

  During site development phase, silt fence will be used along the downhill perimeter of the project to prevent sediment from leaving the site.

  During the building/vertical phase, sediment control will not be necessary on all building bearing pads, as many are flat with well established grass cover. The rest of the landscaped areas and onsite parks will drain to the parking lots or have runoff collected by yard drains. Temporary stabilized lots with slope, or less well established grass cover will be inspected during wet weather conditions and, if required, silt fence may be used as a sediment control. Before removing vegetation on the lots, silt fence will be installed as a sediment control behind curb.

- Storm Drain Inlet Protection (BMP C220)

  Catch basins and storm drain inlets within the project boundary and downstream will have an approved form of inlet protection installed. This will prevent coarse sediment from entering the drainage system prior to permanent stabilization of the disturbed drainage area.

- Temporary Sedimentation Pond (BMP C241)
  Temporary sedimentation ponds will be installed prior to grading the site to ensure proper sediment control from storm runoff prior to discharge from the project site.

  In addition, sediment will be removed from paved areas in and adjacent to construction work areas manually or using a mechanical sweepers, as needed to minimize tracking of sediments on vehicle tires away from the site and to minimize the transmission of sediments from adjacent streets in runoff.

Installation Schedules: Installation schedule to be determined by the General Contractor

Inspection and Maintenance plan: Inspection and maintenance is to take place at the end of each day's work.

Responsible Staff: Certified Erosion and Sediment Control Lead

Element 5: Stabilize Soils (2.1.5)

Exposed and unworked soils shall be stabilized with the application of effective BMPs to prevent erosion throughout the life of the project. The specific BMPs for soil stabilization that shall be used in this project are as follows:

West of the Cascade Mountains Crest

Season	Dates	Number of Days Soils Can be Left Exposed
During the Dry Season	May 1 – September 30	7 days
During the Wet Season	October 1 – April 30	2 days

Soils must be stabilized at the end of the shift before a holiday or weekend if needed based on the weather forecast.

Anticipated project dates: Start date: TBD End date: TBD

Will you construct during the wet season?
☒ Yes ☐ No

List and describe BMPs:

- Temporary and Permanent Seeding (BMP C120)
  Following final or fine grading activity in the rear and side yards, permanent seeding shall be placed on exposed soil to provide permanent erosion protection.

- Mulching (BMP C121)

  During the site development phase, mulching will be used for areas that will be unworked for more than 2 days. Temporary seeding will be applied to areas that will be unworked for more than 7 days. During the building phase, the construction area will be significantly stabilized through well established grass cover. Proposed driveways will receive base course materials as described under Element #2 above. Areas cleared for building foundations or utility and irrigation placement will be temporarily stabilized by one of the following methods which are based on the period exposed soils are left unworked:

  - If exposed soils are left unworked for more than 7 days during the dry season and 2 days during the wet season but less than 30 days, mulching shall be applied.

  - If exposed soils are left unworked for more than 30 days, temporary or permanent seeding shall be applied.

- Nets and Blankets (BMP C122)

Once final or fine grading activity has been completed, install Jute Matting on slopes prior to planting.

- Sodding (BMP C124)

  Following final or fine grading activity in the front yard, sod shall be placed on exposed soil to provide permanent and immediate erosion protection.

- Plastic Covering (BMP C123)

- Topsoiling (BMP C125)

  Utilize stockpile management during all phases of construction per BMP. Cover stockpiles with plastic covering to prevent erosion during rain events.

- Wattles (BMP C235)

  Install wattles downslope of newly landscaped areas to control sediment runoff until stabilization.

  Cement or Calcium Chloride may be used for soil stabilization and dewatering. See section 4.2.2 for pH Sampling Requirements.

  The project site is located west of the Cascade Mountain Crest. As such, no soils shall remain exposed and unworked for more than 7 days during the dry season (May 1 to September 30) and 2 days during the wet season (October 1 to April 30). Regardless of the time of year, all soils shall be stabilized at the end of the shift before a holiday or weekend if needed based on weather forecasts.

  Cut and fill slopes will be stabilized as soon as possible and soil stockpiles will be temporarily covered with plastic sheeting. All stockpiled soils shall be stabilized from erosion, protected with sediment trapping measures, and where possible, be located away from storm drain inlets, waterways, and drainage channels.

Installation Schedules: Installation schedule to be determined by the General Contractor

Inspection and Maintenance plan: Inspection and maintenance is to take place at the end of each day's work.

Responsible Staff: Certified Erosion and Sediment Control Lead

Element 6: Protect Slopes (2.1.6)

All cut and fill slopes will be designed, constructed, and protected in a manner that minimizes erosion. The following specific BMPs will be used to protect slopes for this project:

Will steep slopes be present at the site during construction?
☒ Yes ☐ No

List and describe BMPs:

- Temporary and Permanent Seeding (BMP C120)

  The portion of the site that is being developed is mostly level. Sloping areas within the disturbed portion of the site will be treated as described under Element 5 above.

Installation Schedules: Installation schedule to be determined by the General Contractor

Inspection and Maintenance plan: Inspection and maintenance is to take place at the end of each day's work.

Responsible Staff: Certified Erosion and Sediment Control Lead

Element 7: Protect Drain Inlets (2.1.7)

Drain inlets will be protected using the following BMP methods:

List and describe BMPs:

- Storm Drain Inlet Protection (BMP C220)

  Prior to construction, storm drain inlet protection will be utilized on all catch basins in the roadway along the frontage of any areas receiving stormwater from construction activities within the permitted area. Install inlet protection once permanent storm drain inlets on site are constructed.

Installation Schedules: Installation schedule to be determined by the General Contractor.

Inspection and Maintenance plan: Inspection and maintenance is to take place at the end of each day's work.

Responsible Staff: Certified Erosion and Sediment Control Lead.

Element 8: Stabilize Channels and Outlets (2.1.8)

Where site runoff is to be conveyed in channels or discharged to a stream or some other natural drainage point, efforts will be made to prevent downstream erosion. The specific BMPs for channel and outlet stabilization that shall be used on this project include:

Provide stabilization, including armoring material, adequate to prevent erosion of outlets, adjacent stream banks, slopes, and downstream reaches, will be installed at the outlets of all conveyance systems.

List and describe BMPs:

- Interceptor Dike and Swale (BMP C200)

  During the site development phase, interceptor dikes and swales shall be constructed down slope and on site of the construction site to convey stormwater to an erosion control facility.

- Check Dams (BMP C207)

  Check dams shall be used to reduce the velocity and energy of concentrated flow in swales or ditches.

- Outlet Protection (BMP C209)

Installation Schedules: Installation schedule to be determined by the General Contractor

Inspection and Maintenance plan: Inspection and maintenance is to take place at the end of each day's work.

Responsible Staff: Certified Erosion and Sediment Control Lead

Element 9: Control Pollutants (2.1.9)

All pollutants, including waste materials and demolition debris, that occur onsite shall be handled and disposed of in a manner that does not cause contamination of stormwater. Good housekeeping and preventative measures will be taken to ensure that the site will be kept clean, well organized, and free of debris. If required, BMPs to be implemented to control specific sources of pollutants are discussed below.

The following pollutants are anticipated to be present on-site:

Table 2 – Pollutants

Pollutant (List pollutants and source, if applicable)
Installation of sediment and erosion controls
Installation of stabilized exits
Vehicle tracking
Clearing and grubbing operations
Grading operations
Exposed soils and slopes
Import/export operations
Utility excavation operations
Landscaping operations
Topsoil stripping and stockpiling
Fine grading of home sites
Vertical Construction
Concrete

List and describe BMPs:

- Housekeeping BMPs

The following sections describe the controls, including storage practices to minimize exposure of the materials to stormwater as well as spill prevention and response practices. All pollutants, including waste materials and demolition debris, that occur onsite shall be handled and disposed of in a manner that does not cause contamination of stormwater.

Vehicles, construction equipment, and/or petroleum product storage/dispensing:

- All vehicles, equipment, and petroleum product storage/dispensing areas will be inspected regularly to detect any leaks or spills, and to identify maintenance needs to prevent leaks or spills. Secondary containment such as drip pans will be placed under any leaking vehicles or equipment. All petroleum product storage containers will be placed in secondary containment (see spill prevention and control below).

- On-site fueling tanks and petroleum product storage containers shall include secondary containment.

- Spill prevention measures, such as drip pans, will be used when conducting maintenance and repair of vehicles or equipment or when vehicle/equipment leaks are observed.

- In order to perform emergency repairs on site, temporary plastic will be placed beneath and, if raining, over the vehicle.

- Contaminated surfaces shall be cleaned immediately following any discharge or spill incident.

Chemical storage:

- Any chemicals stored in the construction areas will conform to the appropriate source control BMPs listed in Volume IV of the Ecology stormwater manual. In Western WA, all chemicals shall have cover, containment, and protection provided on site, per BMP C153 for Material Delivery, Storage and Containment in SWMMWW 2012.

- Application of agricultural chemicals, including fertilizers and pesticides, shall be conducted in a manner and at application rates that will not result in loss of chemical to stormwater runoff. Manufacturers' recommendations for application procedures and rates shall be followed.

Concrete and grout:

- Process water and slurry resulting from concrete work will be prevented from entering the waters of the State by implementing Concrete Handling measures (BMP C151) and Sawcutting and Surfacing Pollution Prevention (BMP C152).

Sanitary wastewater:

- Proper sanitary and septic waste management are waste management and material pollution controls that prevent the discharge of pollutants to stormwater from sanitary and septic waste by providing convenient, well-maintained facilities, and arranging for regular service and disposal. Implement as follows:
    - Facilities should be located away from drainage facilities, watercourses, and from traffic circulation.
    - Provide a sufficient quantity of facilities to accommodate the workforce.
    - Temporary sanitary facilities must be equipped with containment to prevent discharge of pollutants to the stormwater drainage system of the receiving water.
    - When subjected to high winds or risk of high winds, temporary sanitary facilities should be secured to prevent overturning.
    - Sanitary facilities should be located in a convenient location.
    - Sanitary or septic wastes should be treated or disposed of in accordance with state and local requirements.
    - Sanitary facilities should be maintained in good working order by a licensed service.

Solid and Liquid Waste:

- Solid and liquid waste generated during construction such as construction materials, contaminated materials, and waste materials from maintenance activities will be prevented from entering the waters of the State. Solid and liquid waste shall be handled in accordance with BMPs for Storage of Liquid, Food Waste, or Dangerous Waste Containers and BMPs for Loading and Unloading Areas for Liquid or Solid Materials.
    - Solid waste will be stored in secure, clearly marked containers.
    - Promptly contain and clean up solid and liquid pollutant leaks and spills including oils, solvents, fuels, and dust from manufacturing operations on any exposed soil, vegetation, or paved area.
    - Sweep paved material handling and storage areas regularly as needed, for the collection and disposal of dust and debris that could contaminate stormwater. Do not hose down pollutants from any area to the ground, storm drain, conveyance ditch, or receiving water unless necessary for dust control purposes to meet air quality regulations.

Installation Schedules: The described BMPs will be implemented while all pollution generating materials are onsite.

Inspection and Maintenance plan: Inspection and maintenance is to take place at the end of each day's work.

Responsible Staff: Certified Erosion and Sediment Control Lead

Will maintenance, fueling, and/or repair of heavy equipment and vehicles occur on-site?
☐ Yes ☒ No

List and describe BMPs:

Spill Prevention and Control BMPs

Prevent or reduce the discharge of pollutants to drainage systems or watercourses from leaks and spills by reducing the chance for spills, stopping the source of spills, containing and cleaning up spills, properly disposing of spill materials, and training employees. This best management practice covers only spill prevention and control. However, Materials Delivery and Storage (BMP C153), also contains useful information, particularly on spill prevention.

- To the extent that the work can be accomplished safely, spills of oil, petroleum products, and substances listed under 40 CFR parts 110,117, and 302, and sanitary and septic wastes should be contained and cleaned up immediately.
- Store hazardous materials and wastes in covered containers and protect from vandalism.
- Place a stockpile of spill cleanup materials where it will be readily accessible.
- Train employees in spill prevention and cleanup.
- Designate responsible individuals to oversee and enforce control measures.
- Spills should be covered and protected from stormwater runon during rainfall to the
- extent that it doesn't compromise clean up activities.
- Do not bury or wash spills with water.

- Store and dispose of used clean up materials, contaminated materials, and recovered spill material that is no longer suitable for the intended purpose in conformance with the provisions in applicable BMPs.
- Do not allow water used for cleaning and decontamination to enter storm drains or watercourses. Collect and dispose of contaminated water in accordance WSDOE regulations.
- Contain water overflow or minor water spillage and do not allow it to discharge into drainage facilities or watercourses.
- Place proper storage, cleanup, and spill reporting instructions for hazardous materials stored or used on the project site in an open, conspicuous, and accessible location.
- Keep waste storage areas clean, well organized, and equipped with ample clean supplies as appropriate for the materials being stored. Perimeter controls, containment structures, covers, and liners should be repaired or replaced as needed to maintain proper function.

Cleanup:

- Clean up leaks and spills immediately.
- Use a rag for small spills on paved surfaces, a damp mop for general cleanup, and absorbent material for larger spills. If the spilled material is hazardous, then the used cleanup materials are also hazardous and must be sent to either a certified laundry (rags) or disposed of as hazardous waste.
- Never hose down or bury dry material spills. Clean up as much of the material as possible and dispose of properly.
- The spill kit should include, at a minimum:
    - 1-Water Resistant Nylon Bag
    - 3-Oil Absorbent Socks 3”x 4’
    - 2-Oil Absorbent Socks 3”x 10’
    - 12-Oil Absorbent Pads 17”x19”
    - 1-Pair Splash Resistant Goggles
    - 3-Pair Nitrile Gloves
    - 10-Disposable Bags with Ties
    - Instructions
- Spill kits will be located in areas with a high potential for spills and deployed in a manner that allows rapid access and use by contractors. Some heavy equipment may have on-board spill kits for small spills. Spill control kits will be inspected and inventoried each construction season to confirm all required items are present. Spill control kits will be inventoried after each emergency event and restocked as needed.

Minor Spills:

- Minor spills typically involve small quantities of oil, gasoline, paint, etc. which can be controlled at the discovery of the spill.
- Contain the spread of the spill.
- Use absorbent materials on small spills rather than hosing down or burying the spill.
- Notify the project foreman immediately
- Recover spilled materials.
- Clean the contaminated area and properly dispose of contaminated materials.
- If the spill occurs on paved or impermeable surfaces, clean up using "dry" methods (absorbent materials, cat litter and/or rags). Contain the spill by encircling with absorbent materials and do not let the spill spread widely.

- If the spill occurs in dirt areas, immediately contain the spill by constructing an earthen dike. Dig up and properly dispose of contaminated soil.
- If the spill occurs during rain, cover spill with tarps or other material to prevent contaminating runoff.

Semi-Significant Spills:

- Semi-significant spills still can be controlled by the first responder along with the aid of other personnel such as laborers and the foreman, etc. This response may require the cessation of all other activities. Spills should be cleaned up immediately.

Significant/Hazardous Spills

- For significant or hazardous spills that cannot be controlled by personnel in the immediate vicinity, the following steps should be taken:
    - Notify the local emergency response by dialing 911. In addition to 911, the contractor will notify the proper City or County officials. All emergency phone numbers will be posted at the construction site.
    - Contact your Supervisor and the Divisional Environmental Manager. For spills of federal reportable quantities, (examples are listed below) in conformance with the requirements in 40 CFR parts 110,119, and 302, the Division Environmental Manager (DEM) will notify the National Response Center at (800) 424-8802. The DEM will notify the Department of Ecology and any other applicable agencies.
- The services of a spills contractor or a Haz-Mat team should be obtained immediately. Construction personnel should not attempt to clean up until the appropriate and qualified staffs have arrived at the job site.
- Notification should first be made by telephone and followed up with a written report. Other agencies which may need to be consulted include, but are not limited to, the Public Works Department, the Coast Guard, the Highway Patrol, the City/County Police Department and Department of Ecology.
- Federal regulations require that any significant oil spill into a water body or onto an adjoining shoreline be reported to the National Response Center (NRC) at 800-424-8802 (24 hours).

Installation Schedules: The described BMPs will be implemented while all pollution generating materials are onsite.

Inspection and Maintenance plan: Inspection and maintenance is to take place at the end of each day's work.

Responsible Staff: Certified Erosion and Sediment Control Lead.

Will wheel wash or tire bath system BMPs be used during construction?
☒ Yes ☐ No

List and describe BMPs:

- Wheel Wash (BMP C106)

Discharge wheel wash or tire bath wastewater to a separate on-site treatment system that prevents discharge to surface water, such as closed-loop recirculation or upland land application, or to the sanitary sewer with local sewer district approval.

Installation Schedules: The described BMPs will be implemented while all pollution generating materials are onsite.

Inspection and Maintenance plan: Inspection and maintenance is to take place at the end of each day's work.

Responsible Staff: Certified Erosion and Sediment Control Lead.

Will pH-modifying sources be present on-site?
☒ Yes ☐ No

Table 3 – pH-Modifying Sources

☐	None
☒	Bulk cement
☐	Cement kiln dust
☐	Fly ash
☒	Other cementitious materials
☒	New concrete washing or curing waters
☒	Waste streams generated from concrete grinding and sawing
☐	Exposed aggregate processes
☐	Dewatering concrete vaults
☐	Concrete pumping and mixer washout waters
☐	Recycled concrete
☐	Other (i.e., calcium lignosulfate) [please describe:]

List and describe BMPs:

- pH Control for High pH Water (BMP C253)
- High pH Neutralization using CO_2 (BMP C252) (Implemented only after notifying the local Jurisdiction.)
- Sawcutting and Surfacing Pollution Prevention

Installation Schedules: The described BMPs will be implemented while all pollution generating materials are onsite.

Inspection and Maintenance plan: Inspection and maintenance is to take place at the end of each day's work.

Responsible Staff: Certified Erosion and Sediment Control Lead.

Concrete trucks must not be washed out onto the ground, or into storm drains, open ditches, streets, or streams. Excess concrete must not be dumped on-site, except in designated concrete washout areas with appropriate BMPs installed.

Element 10: Control Dewatering (2.1.10)

Table 4 – Dewatering BMPs

☐	Infiltration
☒	Transport off-site in a vehicle (vacuum truck for legal disposal)
☐	Ecology-approved on-site chemical treatment or other suitable treatment technologies
☐	Sanitary or combined sewer discharge with local sewer district approval (last resort)
☐	Use of sedimentation bag with discharge to ditch or swale (small volumes of localized dewatering)

List and describe BMPs: Infiltration capacities shall be field verified. Dewatering maybe required during utility excavations. Sump pumps to be utilized as needed.

Installation Schedules: The described BMPs will be implemented while all pollution generating materials are onsite.

Inspection and Maintenance plan: Inspection and maintenance is to take place at the end of each day's work.

Responsible Staff: Certified Erosion and Sediment Control Lead.

Element 11: Maintain BMPs (2.1.11)

All temporary and permanent Erosion and Sediment Control (ESC) BMPs shall be maintained and repaired as needed to ensure continued performance of their intended function.

Maintenance and repair shall be conducted in accordance with each particular BMP specification (see *Volume II of the SWMMWW or Chapter 7 of the SWMMEW*).

Visual monitoring of all BMPs installed at the site will be conducted at least once every calendar week and within 24 hours of any stormwater or non-stormwater discharge from the site. If the site becomes inactive and is temporarily stabilized, the inspection frequency may be reduced to once every calendar month.

All temporary ESC BMPs shall be removed within 30 days after final site stabilization is achieved or after the temporary BMPs are no longer needed.

Trapped sediment shall be stabilized on-site or removed. Disturbed soil resulting from removal of either BMPs or vegetation shall be permanently stabilized.

Additionally, protection must be provided for all BMPs installed for the permanent control of stormwater from sediment and compaction. BMPs that are to remain in place following completion of construction shall be examined and restored to full operating condition. If sediment enters these BMPs during construction, the sediment shall be removed and the facility shall be returned to conditions specified in the construction documents.

Element 12: Manage the Project (2.1.12)

The project will be managed based on the following principles:

- Projects will be phased to the maximum extent practicable and seasonal work limitations will be taken into account.
- Inspection and monitoring:
    - Inspection, maintenance and repair of all BMPs will occur as needed to ensure performance of their intended function.
    - Site inspections and monitoring will be conducted in accordance with Special Condition S4 of the CSWGP. Sampling locations are indicated on the Site Map. Sampling station(s) are located in accordance with applicable requirements of the CSWGP.
- Maintain an updated SWPPP.
    - The SWPPP will be updated, maintained, and implemented in accordance with Special Conditions S3, S4, and S9 of the CSWGP.

As site work progresses the SWPPP will be modified routinely to reflect changing site conditions. The SWPPP will be reviewed monthly to ensure the content is current.

Table 5 – Management

☒	Design the project to fit the existing topography, soils, and drainage patterns
☒	Emphasize erosion control rather than sediment control
☒	Minimize the extent and duration of the area exposed
☒	Keep runoff velocities low
☒	Retain sediment on-site
☒	Thoroughly monitor site and maintain all ESC measures
☒	Schedule major earthwork during the dry season
☐	Other (please describe)

Table 6 – BMP Implementation Schedule

Phase of Construction Project	Stormwater BMPs	Date	Wet/Dry Season
[Insert construction activity]	[Insert BMP]	[MM/DD/YYYY]	[Insert Season]

Phase of Construction Project	Stormwater BMPs	Date	Wet/Dry Season
[Insert construction activity]	[Insert BMP]	[MM/DD/YYYY]	[Insert Season]

Element 13: Protect Low Impact Development (LID) BMPs (2.1.13)

This project proposes infiltration facilities that will require additional protections to ensure that they perform as intended. This project will protect all On-Site Stormwater Management (LID BMPs) by:

a) Protection of LID BMPs from sedimentation will be accomplished through the installation and maintenance of erosion and sediment control BMPs. This project will implement a infiltration trench in order to collect stormwater runoff near the intersection of Freeman Road and N Levee Road. These facilities will be maintained to fully functionality as sediment collects during construction.
b) Protection of LID BMPs from compaction by construction equipment and foot traffic. The location of proposed infiltration facilities has been included on the TESC plans and shall be protected to the greatest extent feasible by avoiding compaction of the soils and avoiding stormwater runoff from entering the proposed infiltration area until site development work is complete.
c) Protection of LID BMPs from sediment-laden runoff to base materials by collection of stormwater runoff and conveyance to the proposed sediment control facilities. Muddy construction equipment shall be prohibited from base materials (proposed subgrade) or LID BMP designated areas.
d) Protection of LID BMPs infiltration performance will be accomplished by cleaning using the procedures in accordance with the Department of Ecology's *Stormwater Management Manual for Western Washington (DOE SMMWW 2019).*
e) Protection of LID BMPs shall be accomplished by prohibiting all heavy equipment off existing soils under proposed LID BMP locations that are close to final grade. Restricting where construction equipment can be staged helps retain the long term design infiltration rate of the soils.

List and describe BMPs:

BMP C200 Interceptor Dike and Swale

BMP C207 Check Dams

BMP C233 Silt Fence

Installation Schedules: TBD

Inspection and Maintenance plan:

Interceptor Dike and Swale Maintenance

- Inspect diversion dikes and interceptor swales once a week and after every rainfall. Immediately remove sediment from the flow area.
- Damage caused by construction traffic or other activity must be repaired before the end of each working day

- Check outlets and make timely repairs as needed to avoid gully formation. When the area below the temporary diversion dike is permanently stabilized, remove the dike and fill and stabilize the channel to blend with the natural surface.

Check Dam Maintenance

- Check dams shall be monitored for performance and sediment accumulation during and after each runoff producing rainfall. Sediment shall be removed when it reaches one half the sump depth.
- Anticipate submergence and deposition above the check dam and erosion from high flows around the edges of the dam.
- If significant erosion occurs between dams, install a protective riprap liner in that portion of the channel.

Silt Fence Maintenance

- Repair any damage immediately.
- Intercept and convey all evident concentrated flows uphill of the silt fence to an infiltration pond.
- Check the uphill side of the fence for signs of the fence clogging and acting as a barrier to flow and then causing channelization of flows parallel to the fence. If this occurs, replace the fence or remove the trapped sediment.
- Remove sediment deposits when the deposit reaches approximately one-third the height of the silt fence, or install a second silt fence.
- Replace filter fabric that has deteriorated due to ultraviolet breakdown.

Responsible Staff: Contractor/CESL

Pollution Prevention Team (3.0)

Table 7 – Team Information

Title	Name(s)	Phone Number
Certified Erosion and Sediment Control Lead (CESCL)	TBD	
Resident Engineer	Jason McArdel	425-251-6222
Emergency Ecology Contact	Southwest Regional Office: WA Emergency Management Division	1-800-258-5990
Emergency Permittee/ Owner Contact	Tyler Litzenberger	425-968-5115
Non-Emergency Owner Contact		
Monitoring Personnel	TBD	
Ecology Regional Office	Southwest Regional Office	(360) 407-6300

Monitoring and Sampling Requirements (4.0)

Monitoring includes visual inspection, sampling for water quality parameters of concern, and documentation of the inspection and sampling findings in a site log book. A site log book will be maintained for all on-site construction activities and will include:

- A record of the implementation of the SWPPP and other permit requirements
- Site inspections
- Stormwater sampling data

The site log book must be maintained on-site within reasonable access to the site and be made available upon request to Ecology or the local jurisdiction.

Numeric effluent limits may be required for certain discharges to 303(d) listed waterbodies. See CSWGP Special Condition S8 and Section 5 of this template.

Site Inspection (4.1)

Site inspections will be conducted at least once every calendar week and within 24 hours following any discharge from the site. For sites that are temporarily stabilized and inactive, the required frequency is reduced to once per calendar month.

The discharge point(s) are indicated on the Site Map (see Appendix A) and in accordance with the applicable requirements of the CSWGP.

Stormwater Quality Sampling (4.2)

Turbidity Sampling (4.2.1)

Requirements include calibrated turbidity meter or transparency tube to sample site discharges for compliance with the CSWGP. Sampling will be conducted at all discharge points at least once per calendar week.

Method for sampling turbidity:

Table 8 – Turbidity Sampling Method

☒	Turbidity Meter/Turbidimeter (required for disturbances 5 acres or greater in size)
☐	Transparency Tube (option for disturbances less than 1 acre and up to 5 acres in size)

The benchmark for turbidity value is 25 nephelometric turbidity units (NTU) and a transparency less than 33 centimeters.

If the discharge's turbidity is 26 to 249 NTU **or** the transparency is less than 33 cm but equal to or greater than 6 cm, the following steps will be conducted:

1. Review the SWPPP for compliance with Special Condition S9. Make appropriate revisions within 7 days of the date the discharge exceeded the benchmark.

2. Immediately begin the process to fully implement and maintain appropriate source control and/or treatment BMPs as soon as possible. Address the problems within 10 days of the date the discharge exceeded the benchmark. If installation of necessary treatment BMPs is not feasible within 10 days, Ecology may approve additional time when the Permittee requests an extension within the initial 10-day response period.
3. Document BMP implementation and maintenance in the site log book.

If the turbidity exceeds 250 NTU **or** the transparency is 6 cm or less at any time, the following steps will be conducted:

1. Telephone or submit an electronic report to the applicable Ecology Region's Environmental Report Tracking System (ERTS) within 24 hours. https://www.ecology.wa.gov/About-us/Get-involved/Report-an-environmental-issue
    - Central Region (Benton, Chelan, Douglas, Kittitas, Klickitat, Okanogan, Yakima): (509) 575-2490
    - Eastern Region (Adams, Asotin, Columbia, Ferry, Franklin, Garfield, Grant, Lincoln, Pend Oreille, Spokane, Stevens, Walla Walla, Whitman): (509) 329-3400
    - Northwest Region (King, Kitsap, Island, San Juan, Skagit, Snohomish, Whatcom): (425) 649-7000
    - Southwest Region (Clallam, Clark, Cowlitz, Grays Harbor, Jefferson, Lewis, Mason, Pacific, Pierce, Skamania, Thurston, Wahkiakum,): (360) 407-6300
2. Immediately begin the process to fully implement and maintain appropriate source control and/or treatment BMPs as soon as possible. Address the problems within 10 days of the date the discharge exceeded the benchmark. If installation of necessary treatment BMPs is not feasible within 10 days, Ecology may approve additional time when the Permittee requests an extension within the initial 10-day response period
3. Document BMP implementation and maintenance in the site log book.
4. Continue to sample discharges daily until one of the following is true:
    - Turbidity is 25 NTU (or lower).
    - Transparency is 33 cm (or greater).
    - Compliance with the water quality limit for turbidity is achieved.
        - 1 - 5 NTU over background turbidity, if background is less than 50 NTU
        - 1% - 10% over background turbidity, if background is 50 NTU or greater
    - The discharge stops or is eliminated.

pH Sampling (4.2.2)

pH monitoring is required for “Significant concrete work” (i.e. greater than 1000 cubic yards poured concrete or recycled concrete over the life of the project).The use of engineered soils (soil amendments including but not limited to Portland cement-treated base [CTB], cement kiln dust [CKD] or fly ash) also requires pH monitoring.

For significant concrete work, pH sampling will start the first day concrete is poured and continue until it is cured, typically three (3) weeks after the last pour.

For engineered soils and recycled concrete, pH sampling begins when engineered soils or recycled concrete are first exposed to precipitation and continues until the area is fully stabilized.

If the measured pH is 8.5 or greater, the following measures will be taken:

1. Prevent high pH water from entering storm sewer systems or surface water.
2. Adjust or neutralize the high pH water to the range of 6.5 to 8.5 su using appropriate technology such as carbon dioxide (CO_2) sparging (liquid or dry ice).
3. Written approval will be obtained from Ecology prior to the use of chemical treatment other than CO_2 sparging or dry ice.

Method for sampling pH:

Table 9 – pH Sampling Method

☒	pH meter
☐	pH test kit
☐	Wide range pH indicator paper

Discharges to 303(d) or Total Maximum Daily Load (TMDL) Waterbodies (5.0)

303(d) Listed Waterbodies (5.1)

Is the receiving water 303(d) (Category 5) listed for turbidity, fine sediment, phosphorus, or pH?

☐ Yes ☒ No

List the impairment(s):

N/A

TMDL Waterbodies (5.2)

Waste Load Allocation for CWSGP discharges:

N/A

List and describe BMPs:

N/A

Discharges to TMDL receiving waterbodies will meet in-stream water quality criteria at the point of discharge.

The Construction Stormwater General Permit Proposed New Discharge to an Impaired Water Body form is included in Appendix F.

Reporting and Record Keeping (6.0)

Record Keeping (6.1)

Site Log Book (6.1.1)

A site log book will be maintained for all on-site construction activities and will include:

- A record of the implementation of the SWPPP and other permit requirements
- Site inspections
- Sample logs

Records Retention (6.1.2)

Records will be retained during the life of the project and for a minimum of three (3) years following the termination of permit coverage in accordance with Special Condition S5.C of the CSWGP.

Permit documentation to be retained on-site:

- CSWGP
- Permit Coverage Letter
- SWPPP
- Site Log Book

Permit documentation will be provided within 14 days of receipt of a written request from Ecology. A copy of the SWPPP or access to the SWPPP will be provided to the public when requested in writing in accordance with Special Condition S5.G.2.b of the CSWGP.

Updating the SWPPP (6.1.3)

The SWPPP will be modified if:

- Found ineffective in eliminating or significantly minimizing pollutants in stormwater discharges from the site.
- There is a change in design, construction, operation, or maintenance at the construction site that has, or could have, a significant effect on the discharge of pollutants to waters of the State.

The SWPPP will be modified within seven (7) days if inspection(s) or investigation(s) determine additional or modified BMPs are necessary for compliance. An updated timeline for BMP implementation will be prepared.

Reporting (6.2)

Discharge Monitoring Reports (6.2.1)

Cumulative soil disturbance is one (1) acre or larger; therefore, Discharge Monitoring Reports (DMRs) will be submitted to Ecology monthly. If there was no discharge during a given monitoring period the DMR will be submitted as required, reporting "No Discharge". The DMR due date is fifteen (15) days following the end of each calendar month.

DMRs will be reported online through Ecology's WQWebDMR System.

To sign up for WQWebDMR go to:
https://www.ecology.wa.gov/Regulations-Permits/Guidance-technical-assistance/Water-quality-permits-guidance/WQWebPortal-guidance

Notification of Noncompliance (6.2.2)

If any of the terms and conditions of the permit is not met, and the resulting noncompliance may cause a threat to human health or the environment, the following actions will be taken:

1. Ecology will be notified within 24-hours of the failure to comply by calling the applicable Regional office ERTS phone number (Regional office numbers listed below).
2. Immediate action will be taken to prevent the discharge/pollution or otherwise stop or correct the noncompliance. If applicable, sampling and analysis of any noncompliance will be repeated immediately and the results submitted to Ecology within five (5) days of becoming aware of the violation.
3. A detailed written report describing the noncompliance will be submitted to Ecology within five (5) days, unless requested earlier by Ecology.

Specific information to be included in the noncompliance report is found in Special Condition S5.F.3 of the CSWGP.

Anytime turbidity sampling indicates turbidity is 250 NTUs or greater, or water transparency is 6 cm or less, the Ecology Regional office will be notified by phone within 24 hours of analysis as required by Special Condition S5.A of the CSWGP.

- Central Region at (509) 575-2490 for Benton, Chelan, Douglas, Kittitas, Klickitat, Okanogan, or Yakima County
- Eastern Region at (509) 329-3400 for Adams, Asotin, Columbia, Ferry, Franklin, Garfield, Grant, Lincoln, Pend Oreille, Spokane, Stevens, Walla Walla, or Whitman County
- Northwest Region at (425) 649-7000 for Island, King, Kitsap, San Juan, Skagit, Snohomish, or Whatcom County
- Southwest Region at (360) 407-6300 for Clallam, Clark, Cowlitz, Grays Harbor, Jefferson, Lewis, Mason, Pacific, Pierce, Skamania, Thurston, or Wahkiakum

Include the following information:

1. Your name and / Phone number
2. Permit number
3. City / County of project
4. Sample results
5. Date / Time of call
6. Date / Time of sample
7. Project name

In accordance with Special Condition S4.D.5.b of the CSWGP, the Ecology Regional office will be notified if chemical treatment other than CO_2 sparging is planned for adjustment of high pH water.

Appendix/Glossary

A. Site Map
B. BMP Detail
C. Correspondence
D. Site Inspection Form
E. Construction Stormwater General Permit (CSWGP)
F. 303(d) List Waterbodies / TMDL Waterbodies Information
G. Contaminated Site Information
H. Engineering Calculations

APPENDIX A



REFERENCE: MapQuest (2022)

Scale:
Horizontal: **N.T.S.** Vertical: **N/A**

Barghausen Consulting Engineers, Inc.
18215 72nd Avenue South
Kent, WA 98032
425.251.6222 **barghausen.com**

For:
Freeman Road Logistics
Fife, Washington

Title:
VICINITY MAP

Job Number
21585

DATE: 09/01/22

P:\21000s\21585\exhibit\graphics\21585 vmap.cdr

APPENDIX B

Maintenance Standards

Inspect the area frequently to make sure flagging remains in place and the area remains undisturbed. Replace all damaged flagging immediately. Remove all materials located in the buffer area that may impede the ability of the vegetation to act as a filter.

BMP C103: High-Visibility Fence

Purpose

High-visibility fencing is intended to:

- Restrict clearing to approved limits.
- Prevent disturbance of sensitive areas, their buffers, and other areas required to be left undisturbed.
- Limit construction traffic to designated construction entrances, exits, or internal roads.
- Protect areas where marking with survey tape may not provide adequate protection.

Conditions of Use

To establish clearing limits plastic, fabric, or metal fence may be used:

- At the boundary of sensitive areas, their buffers, and other areas required to be left uncleared.
- As necessary to control vehicle access to and on the site.

Design and Installation Specifications

High-visibility plastic fence shall be composed of a high-density polyethylene material and shall be at least four feet in height. Posts for the fencing shall be steel or wood and placed every 6 feet on center (maximum) or as needed to ensure rigidity. The fencing shall be fastened to the post every six inches with a polyethylene tie. On long continuous lengths of fencing, a tension wire or rope shall be used as a top stringer to prevent sagging between posts. The fence color shall be high-visibility orange. The fence tensile strength shall be 360 lbs/ft using the ASTM D4595 testing method.

If appropriate install fabric silt fence in accordance with BMP C233: Silt Fence to act as high-visibility fence. Silt fence shall be at least 3 feet high and must be highly visible to meet the requirements of this BMP.

Metal fences shall be designed and installed according to the manufacturer's specifications.

Metal fences shall be at least 3 feet high and must be highly visible.

Fences shall not be wired or stapled to trees.

Maintenance Standards

If the fence has been damaged or visibility reduced, it shall be repaired or replaced immediately and visibility restored.

BMP C105: Stabilized Construction Access

Purpose

Stabilized construction accesses are established to reduce the amount of sediment transported onto paved roads outside the project site by vehicles or equipment. This is done by constructing a stabilized pad of quarry spalls at entrances and exits for project sites.

Conditions of Use

Construction accesses shall be stabilized wherever traffic will be entering or leaving a construction site if paved roads or other paved areas are within 1,000 feet of the site.

For residential subdivision construction sites, provide a stabilized construction access for each residence, rather than only at the main subdivision entrance. Stabilized surfaces shall be of sufficient length/width to provide vehicle access/parking, based on lot size and configuration.

On large commercial, highway, and road projects, the designer should include enough extra materials in the contract to allow for additional stabilized accesses not shown in the initial Construction SWPPP. It is difficult to determine exactly where access to these projects will take place; additional materials will enable the contractor to install them where needed.

Design and Installation Specifications

See Figure II-3.1: Stabilized Construction Access for details. Note: the 100' minimum length of the access shall be reduced to the maximum practicable size when the size or configuration of the site does not allow the full length (100').

Construct stabilized construction accesses with a 12-inch thick pad of 4-inch to 8-inch quarry spalls, a 4-inch course of asphalt treated base (ATB), or use existing pavement. Do not use crushed concrete, cement, or calcium chloride for construction access stabilization because these products raise pH levels in stormwater and concrete discharge to waters of the State is prohibited.

A separation geotextile shall be placed under the spalls to prevent fine sediment from pumping up into the rock pad. The geotextile shall meet the standards listed in Table II-3.2: Stabilized Construction Access Geotextile Standards.

Table II-3.2: Stabilized Construction Access Geotextile Standards

Geotextile Property	Required Value
Grab Tensile Strength (ASTM D4751)	200 psi min.

Table II-3.2: Stabilized Construction Access Geotextile Standards (continued)

Geotextile Property	Required Value
Grab Tensile Elongation (ASTM D4632)	30% max.
Mullen Burst Strength (ASTM D3786-80a)	400 psi min.
AOS (ASTM D4751)	20-45 (U.S. standard sieve size)

- Consider early installation of the first lift of asphalt in areas that will be paved; this can be used as a stabilized access. Also consider the installation of excess concrete as a stabilized access. During large concrete pours, excess concrete is often available for this purpose.
- Fencing (see BMP C103: High-Visibility Fence) shall be installed as necessary to restrict traffic to the construction access.
- Whenever possible, the access shall be constructed on a firm, compacted subgrade. This can substantially increase the effectiveness of the pad and reduce the need for maintenance.
- Construction accesses should avoid crossing existing sidewalks and back of walk drains if at all possible. If a construction access must cross a sidewalk or back of walk drain, the full length of the sidewalk and back of walk drain must be covered and protected from sediment leaving the site.

Alternative Material Specification

WSDOT has raised safety concerns about the Quarry Spall rock specified above. WSDOT observes that the 4-inch to 8-inch rock sizes can become trapped between Dually truck tires, and then released off-site at highway speeds. WSDOT has chosen to use a modified specification for the rock while continuously verifying that the Stabilized Construction Access remains effective. To remain effective, the BMP must prevent sediment from migrating off site. To date, there has been no performance testing to verify operation of this new specification. Jurisdictions may use the alternative specification, but must perform increased off-site inspection if they use, or allow others to use, it.

Stabilized Construction Accesses may use material that meets the requirements of WSDOT's *Standard Specifications for Road, Bridge, and Municipal Construction* Section 9-03.9(1) (WSDOT, 2016) for ballast except for the following special requirements.

The grading and quality requirements are listed in Table II-3.3: Stabilized Construction Access Alternative Material Requirements.

Table II-3.3: Stabilized Construction Access Alternative Material Requirements

Sieve Size	Percent Passing
2½"	99-100

Table II-3.3: Stabilized Construction Access Alternative Material Requirements (continued)

Sieve Size	Percent Passing
2″	65-100
¾″	40-80
No. 4	5 max.
No. 100	0-2
% Fracture	75 min.

- All percentages are by weight.
- The sand equivalent value and dust ratio requirements do not apply.
- The fracture requirement shall be at least one fractured face and will apply the combined aggregate retained on the No. 4 sieve in accordance with FOP for AASHTO T 335.


Maintenance Standards

Quarry spalls shall be added if the pad is no longer in accordance with the specifications.

- If the access is not preventing sediment from being tracked onto pavement, then alternative measures to keep the streets free of sediment shall be used. This may include replacement/cleaning of the existing quarry spalls, street sweeping, an increase in the dimensions of the access, or the installation of BMP C106: Wheel Wash.
- Any sediment that is tracked onto pavement shall be removed by shoveling or street sweeping. The sediment collected by sweeping shall be removed or stabilized on site. The pavement shall not be cleaned by washing down the street, except when high efficiency sweeping is ineffective and there is a threat to public safety. If it is necessary to wash the streets, the construction of a small sump to contain the wash water shall be considered. The sediment would then be washed into the sump where it can be controlled.
- Perform street sweeping by hand or with a high efficiency sweeper. Do not use a non-high efficiency mechanical sweeper because this creates dust and throws soils into storm systems or conveyance ditches.
- Any quarry spalls that are loosened from the pad, which end up on the roadway shall be removed immediately.
- If vehicles are entering or exiting the site at points other than the construction access(es), BMP C103: High-Visibility Fence shall be installed to control traffic.

- Upon project completion and site stabilization, all construction accesses intended as permanent access for maintenance shall be permanently stabilized.

Figure II-3.1: Stabilized Construction Access

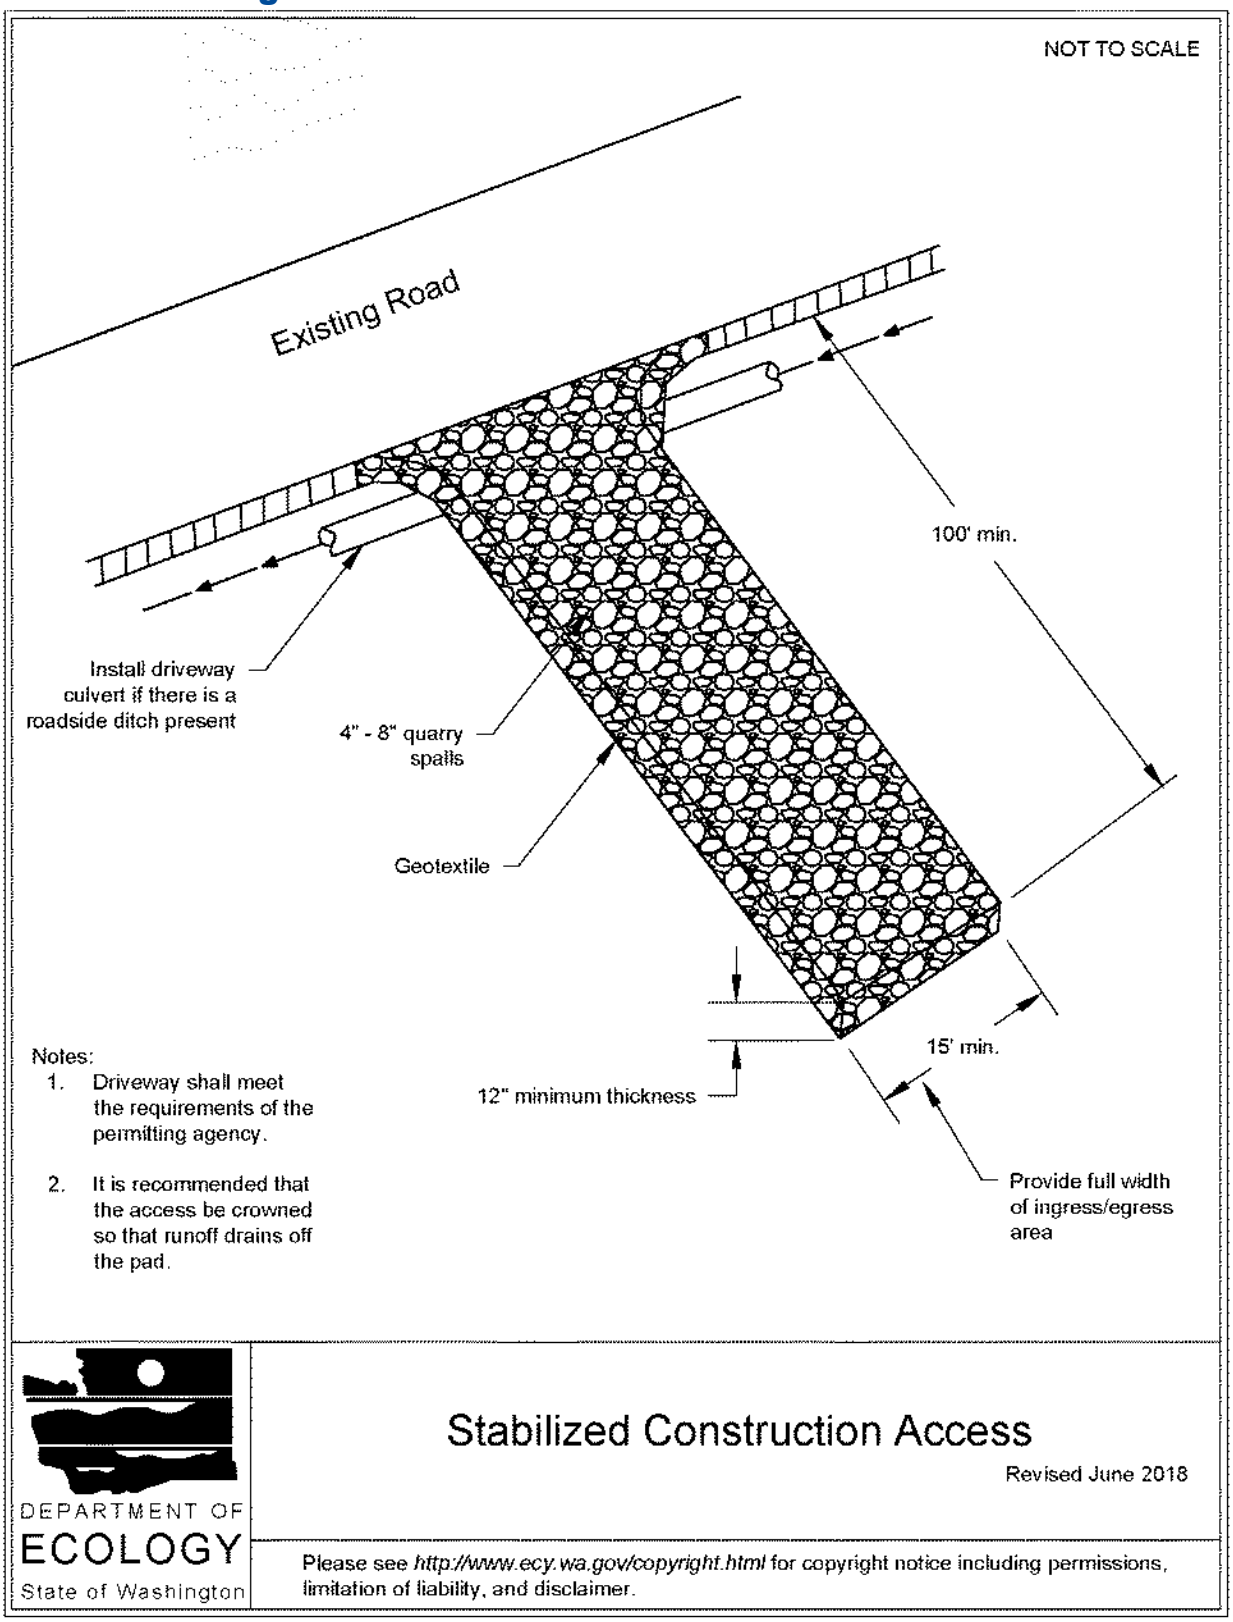

Approved as Functionally Equivalent

Ecology has approved products as able to meet the requirements of this BMP. The products did not pass through the Technology Assessment Protocol – Ecology (TAPE) process. Local jurisdictions may choose not to accept these products, or may require additional testing prior to consideration for local use. Products that Ecology has approved as functionally equivalent are available for review on Ecology's website at:

https://ecology.wa.gov/Regulations-Permits/Guidance-technical-assistance/Stormwater-permittee-guidance-resources/Emerging-stormwater-treatment-technologies

BMP C106: Wheel Wash

Purpose

Wheel washes reduce the amount of sediment transported onto paved roads by washing dirt from the wheels of motor vehicles prior to the motor vehicles leaving the construction site.

Conditions of Use

- Use a wheel wash when BMP C105: Stabilized Construction Access is not preventing sediment from being tracked off site.
- Wheel washing is generally an effective BMP when installed with careful attention to topography. For example, a wheel wash can be detrimental if installed at the top of a slope abutting a right-of-way where the water from the dripping truck can run unimpeded into the street.
- Pressure washing combined with an adequately sized and surfaced pad with direct drainage to a large 10-foot x 10-foot sump can be very effective.
- Wheel wash wastewater is not stormwater. It is commonly called process water, and must be discharged to a separate on-site treatment system that prevents discharge to waters of the State, or to the sanitary sewer with local sewer district approval.
- Wheel washes may use closed-loop recirculation systems to conserve water use.
- Wheel wash wastewater shall not include wastewater from concrete washout areas.
- When practical, the wheel wash should be placed in sequence with BMP C105: Stabilized Construction Access. Locate the wheel wash such that vehicles exiting the wheel wash will enter directly onto BMP C105: Stabilized Construction Access. In order to achieve this, BMP C105: Stabilized Construction Access may need to be extended beyond the standard installation to meet the exit of the wheel wash.

Design and Installation Specifications

Suggested details are shown in Figure II-3.2: Wheel Wash. The Local Permitting Authority may allow other designs. A minimum of 6 inches of asphalt treated base (ATB) over crushed base material or 8 inches over a good subgrade is recommended to pave the wheel wash.

Use a low clearance truck to test the wheel wash before paving. Either a belly dump or lowboy will work well to test clearance.

Keep the water level from 12 to 14 inches deep to avoid damage to truck hubs and filling the truck tongues with water.

Midpoint spray nozzles are only needed in extremely muddy conditions.

Wheel wash systems should be designed with a small grade change, 6- to 12-inches for a 10-foot-wide pond, to allow sediment to flow to the low side of pond to help prevent re-suspension of sediment. A drainpipe with a 2- to 3-foot riser should be installed on the low side of the pond to allow for easy cleaning and refilling. Polymers may be used to promote coagulation and flocculation in a closed-loop system. Polyacrylamide (PAM) added to the wheel wash water at a rate of 0.25 - 0.5 pounds per 1,000 gallons of water increases effectiveness and reduces cleanup time. If PAM is already being used for dust or erosion control and is being applied by a water truck, the same truck can be used to change the wash water.

Maintenance Standards

The wheel wash should start out each day with fresh water.


The wheel wash water should be changed a minimum of once per day. On large earthwork jobs where more than 10-20 trucks per hour are expected, the wheel wash water will need to be changed more often.

Approved as Functionally Equivalent

Ecology has approved products as able to meet the requirements of this BMP. The products did not pass through the Technology Assessment Protocol – Ecology (TAPE) process. Local jurisdictions may choose not to accept these products, or may require additional testing prior to consideration for local use. Products that Ecology has approved as functionally equivalent are available for review on Ecology's website at:

https://ecology.wa.gov/Regulations-Permits/Guidance-technical-assistance/Stormwater-permittee-guidance-resources/Emerging-stormwater-treatment-technologies

Figure II-3.2: Wheel Wash

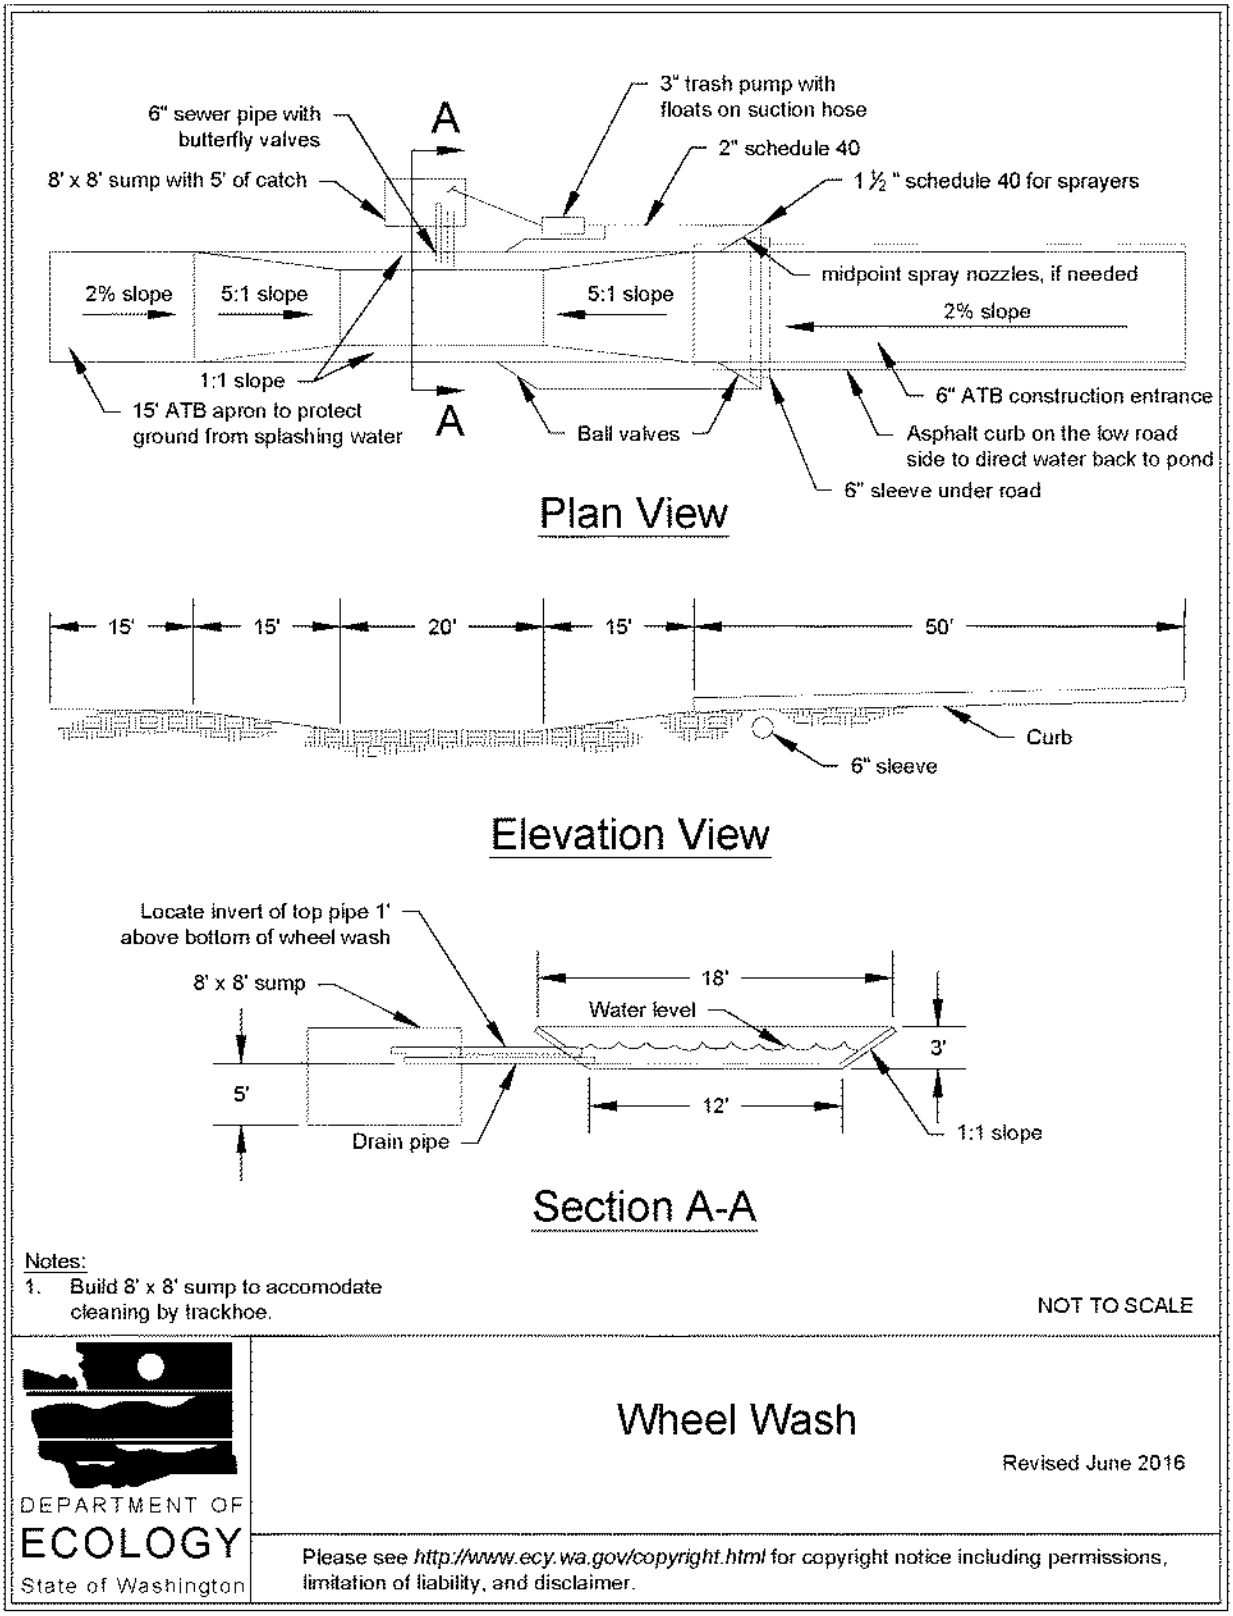

BMP C107: Construction Road / Parking Area Stabilization

Purpose

Stabilizing roads, parking areas, and other on-site vehicle transportation routes immediately after grading reduces erosion caused by construction traffic or stormwater runoff.

Conditions of Use

Roads and parking areas shall be stabilized wherever they are constructed, whether permanent or temporary, for use by construction traffic.

BMP C103: High-Visibility Fence shall be installed, if necessary, to limit the access of vehicles to only those roads and parking areas that are stabilized.

Design and Installation Specifications

- On areas that will receive asphalt as part of the project, install the first lift as soon as possible.
- A 6-inch depth of 2- to 4-inch crushed rock, gravel base, or crushed surfacing base course shall be applied immediately after grading or utility installation. A 4-inch course of asphalt treated base (ATB) may also be used, or the road/parking area may be paved. It may also be possible to use cement or calcium chloride for soil stabilization. If cement or cement kiln dust is used for roadbase stabilization, pH monitoring and BMP C252: Treating and Disposing of High pH Water is necessary to evaluate and minimize the effects on stormwater. If the area will not be used for permanent roads, parking areas, or structures, a 6-inch depth of hog fuel may also be used, but this is likely to require more maintenance. Whenever possible, construction roads and parking areas shall be placed on a firm, compacted subgrade.
- Temporary road gradients shall not exceed 15 percent. Roadways shall be carefully graded to drain. Drainage ditches shall be provided on each side of the roadway in the case of a crowned section, or on one side in the case of a super-elevated section. Drainage ditches shall be directed to a sediment control BMP.
- Rather than relying on ditches, it may also be possible to grade the road so that runoff sheetflows into a heavily vegetated area with a well-developed topsoil. Landscaped areas are not adequate. If this area has at least 50 feet of vegetation that water can flow through, then it is generally preferable to use the vegetation to treat runoff, rather than a sediment pond or trap. The 50 feet shall not include wetlands or their buffers. If runoff is allowed to sheetflow through adjacent vegetated areas, it is vital to design the roadways and parking areas so that no concentrated runoff is created.
- Storm drain inlets shall be protected to prevent sediment-laden water entering the drainage system (see BMP C220: Inlet Protection).

Maintenance Standards

Inspect stabilized areas regularly, especially after large storm events.

Crushed rock, gravel base, etc., shall be added as required to maintain a stable driving surface and to stabilize any areas that have eroded.

Following construction, these areas shall be restored to pre-construction condition or better to prevent future erosion.

Perform street cleaning at the end of each day or more often if necessary.

BMP C120: Temporary and Permanent Seeding

Purpose

Seeding reduces erosion by stabilizing exposed soils. A well-established vegetative cover is one of the most effective methods of reducing erosion.

Conditions of Use

Use seeding throughout the project on disturbed areas that have reached final grade or that will remain unworked for more than 30 days.

The optimum seeding windows for western Washington are April 1 through June 30 and September 1 through October 1.

Between July 1 and August 30 seeding requires irrigation until 75 percent grass cover is established.

Between October 1 and March 30 seeding requires a cover of mulch or an erosion control blanket until 75 percent grass cover is established.

Review all disturbed areas in late August to early September and complete all seeding by the end of September. Otherwise, vegetation will not establish itself enough to provide more than average protection.

Mulch is required at all times for seeding because it protects seeds from heat, moisture loss, and transport due to runoff. Mulch can be applied on top of the seed or simultaneously by hydroseeding. See BMP C121: Mulching for specifications.

Seed and mulch all disturbed areas not otherwise vegetated at final site stabilization. Final stabilization means the completion of all soil disturbing activities at the site and the establishment of a permanent vegetative cover, or equivalent permanent stabilization measures (such as pavement, riprap, gabions, or geotextiles) which will prevent erosion. See BMP T5.13: Post-Construction Soil Quality and Depth.

Design and Installation Specifications

General

- Install channels intended for vegetation before starting major earthwork and hydroseed with a Bonded Fiber Matrix. For vegetated channels that will have high flows, install erosion control blankets over the top of hydroseed. Before allowing water to flow in vegetated channels, establish 75 percent vegetation cover. If vegetated channels cannot be established by seed

before water flow; install sod in the channel bottom — over top of hydromulch and erosion control blankets.

- Confirm the installation of all required surface water control measures to prevent seed from washing away.
- Hydroseed applications shall include a minimum of 1,500 pounds per acre of mulch with 3 percent tackifier. See BMP C121: Mulching for specifications.
- Areas that will have seeding only and not landscaping may need compost or meal-based mulch included in the hydroseed in order to establish vegetation. Re-install native topsoil on the disturbed soil surface before application. See BMP T5.13: Post-Construction Soil Quality and Depth.
- When installing seed via hydroseeding operations, only about 1/3 of the seed actually ends up in contact with the soil surface. This reduces the ability to establish a good stand of grass quickly. To overcome this, consider increasing seed quantities by up to 50 percent.
- Enhance vegetation establishment by dividing the hydromulch operation into two phases:
    - Phase 1- Install all seed and fertilizer with 25-30 percent mulch and tackifier onto soil in the first lift.
    - Phase 2- Install the rest of the mulch and tackifier over the first lift.

  Or, enhance vegetation by:
    - Installing the mulch, seed, fertilizer, and tackifier in one lift.
    - Spread or blow straw over the top of the hydromulch at a rate of 800-1000 pounds per acre.
    - Hold straw in place with a standard tackifier.

  Both of these approaches will increase cost moderately but will greatly improve and enhance vegetative establishment. The increased cost may be offset by the reduced need for:
    - Irrigation.
    - Reapplication of mulch.
    - Repair of failed slope surfaces.

  This technique works with standard hydromulch (1,500 pounds per acre minimum) and Bonded Fiber Matrix/ Mechanically Bonded Fiber Matrix (BFM/MBFMs) (3,000 pounds per acre minimum).
- Seed may be installed by hand if:
    - Temporary and covered by straw, mulch, or topsoil.
    - Permanent in small areas (usually less than 1 acre) and covered with mulch, topsoil, or erosion blankets.
- The seed mixes listed in Table II-3.4: Temporary and Permanent Seed Mixes include

recommended mixes for both temporary and permanent seeding.

- Apply these mixes, with the exception of the wet area seed mix, at a rate of 120 pounds per acre. This rate can be reduced if soil amendments or slow-release fertilizers are used. Apply the wet area seed mix at a rate of 60 pounds per acre.
- Consult the local suppliers or the local conservation district for their recommendations. The appropriate mix depends on a variety of factors, including location, exposure, soil type, slope, and expected foot traffic. Alternative seed mixes approved by the local authority may be used, depending on the soil type and hydrology of the area.

Table II-3.4: Temporary and Permanent Seed Mixes

Common Name	Latin Name	% Weight	% Purity	% Germination
Temporary Erosion Control Seed Mix A standard mix for areas requiring a temporary vegetative cover.				
Chewings or annual blue grass	*Festuca rubra var. commutata* or *Poa anna*	40	98	90
Perennial rye	*Lolium perenne*	50	98	90
Redtop or colonial bentgrass	*Agrostis alba* or *Agrostis tenuis*	5	92	85
White dutch clover	*Trifolium repens*	5	98	90
Landscaping Seed Mix A recommended mix for landscaping seed.				
Perennial rye blend	*Lolium perenne*	70	98	90
Chewings and red fescue blend	*Festuca rubra var. commutata* or *Festuca rubra*	30	98	90
Low-Growing Turf Seed Mix A turf seed mix for dry situations where there is no need for watering. This mix requires very little maintenance.				
Dwarf tall fescue (several varieties)	*Festuca arundinacea var.*	45	98	90
Dwarf perennial rye (Barclay)	*Lolium perenne var. barclay*	30	98	90
Red fescue	*Festuca rubra*	20	98	90
Colonial bentgrass	*Agrostis tenuis*	5	98	90
Bioswale Seed Mix A seed mix for bioswales and other intermittently wet areas.				
Tall or meadow fes-	*Festuca arundin-*	75-80	98	90

Table II-3.4: Temporary and Permanent Seed Mixes (continued)

Common Name	Latin Name	% Weight	% Purity	% Germination
cue	*acea* or *Festuca elatior*			
Seaside/Creeping bentgrass	*Agrostis palustris*	10-15	92	85
Redtop bentgrass	*Agrostis alba* or *Agrostis gigantea*	5-10	90	80
Wet Area Seed Mix A low-growing, relatively non-invasive seed mix appropriate for very wet areas that are not regulated wetlands. Consult Hydraulic Permit Authority (HPA) for seed mixes if applicable.				
Tall or meadow fescue	*Festuca arundinacea* or *Festuca elatior*	60-70	98	90
Seaside/Creeping bentgrass	*Agrostis palustris*	10-15	98	85
Meadow foxtail	*Alepocurus pratensis*	10-15	90	80
Alsike clover	*Trifolium hybridum*	1-6	98	90
Redtop bentgrass	*Agrostis alba*	1-6	92	85
Meadow Seed Mix A recommended meadow seed mix for infrequently maintained areas or non-maintained areas where colonization by native plants is desirable. Likely applications include rural road and utility right-of-way. Seeding should take place in September or very early October in order to obtain adequate establishment prior to the winter months. Consider the appropriateness of clover, a fairly invasive species, in the mix. Amending the soil can reduce the need for clover.				
Redtop or Oregon bentgrass	*Agrostis alba* or *Agrostis oregonensis*	20	92	85
Red fescue	*Festuca rubra*	70	98	90
White dutch clover	*Trifolium repens*	10	98	90

Roughening and Rototilling

- The seedbed should be firm and rough. Roughen all soil no matter what the slope. Track walk slopes before seeding if engineering purposes require compaction. Backblading or smoothing of slopes greater than 4H:1V is not allowed if they are to be seeded.
- Restoration-based landscape practices require deeper incorporation than that provided by a simple single-pass rototilling treatment. Wherever practical, initially rip the subgrade to improve long-term permeability, infiltration, and water inflow qualities. At a minimum,

permanent areas shall use soil amendments to achieve organic matter and permeability performance defined in engineered soil/landscape systems. For systems that are deeper than 8 inches complete the rototilling process in multiple lifts, or prepare the engineered soil system per specifications and place to achieve the specified depth.

Fertilizers

- Conducting soil tests to determine the exact type and quantity of fertilizer is recommended. This will prevent the over-application of fertilizer.
- Organic matter is the most appropriate form of fertilizer because it provides nutrients (including nitrogen, phosphorus, and potassium) in the least water-soluble form.
- In general, use 10-4-6 N-P-K (nitrogen-phosphorus-potassium) fertilizer at a rate of 90 pounds per acre. Always use slow-release fertilizers because they are more efficient and have fewer environmental impacts. Do not add fertilizer to the hydromulch machine, or agitate, more than 20 minutes before use. Too much agitation destroys the slow-release coating.
- There are numerous products available that take the place of chemical fertilizers. These include several with seaweed extracts that are beneficial to soil microbes and organisms. If 100 percent cottonseed meal is used as the mulch in hydroseed, chemical fertilizer may not be necessary. Cottonseed meal provides a good source of long-term, slow-release, available nitrogen.

Bonded Fiber Matrix and Mechanically Bonded Fiber Matrix

- On steep slopes use Bonded Fiber Matrix (BFM) or Mechanically Bonded Fiber Matrix (MBFM) products. Apply BFM/MBFM products at a minimum rate of 3,000 pounds per acre with approximately 10 percent tackifier. Achieve a minimum of 95 percent soil coverage during application. Numerous products are available commercially. Most products require 24-36 hours to cure before rainfall and cannot be installed on wet or saturated soils. Generally, products come in 40-50 pound bags and include all necessary ingredients except for seed and fertilizer.
- Install products per manufacturer's instructions.
- BFMs and MBFMs provide good alternatives to blankets in most areas requiring vegetation establishment. Advantages over blankets include:
    - BFM and MBFMs do not require surface preparation.
    - Helicopters can assist in installing BFM and MBFMs in remote areas.
    - On slopes steeper than 2.5H:1V, blanket installers may require ropes and harnesses for safety.
    - Installing BFM and MBFMs can save at least $1,000 per acre compared to blankets.

Maintenance Standards

Reseed any seeded areas that fail to establish at least 75 percent cover (100 percent cover for areas that receive sheet or concentrated flows). If reseeding is ineffective, use an alternate method such as sodding, mulching, nets, or blankets.

- Reseed and protect by mulch any areas that experience erosion after achieving adequate cover. Reseed and protect by mulch any eroded area.
- Supply seeded areas with adequate moisture, but do not water to the extent that it causes run-off.

Approved as Functionally Equivalent

Ecology has approved products as able to meet the requirements of this BMP. The products did not pass through the Technology Assessment Protocol – Ecology (TAPE) process. Local jurisdictions may choose not to accept these products, or may require additional testing prior to consideration for local use. Products that Ecology has approved as functionally equivalent are available for review on Ecology's website at:

https://ecology.wa.gov/Regulations-Permits/Guidance-technical-assistance/Stormwater-permittee-guidance-resources/Emerging-stormwater-treatment-technologies

BMP C121: Mulching

Purpose

Mulching soils provides immediate temporary protection from erosion. Mulch also enhances plant establishment by conserving moisture, holding fertilizer, seed, and topsoil in place, and moderating soil temperatures. There are a variety of mulches that can be used. This section discusses only the most common types of mulch.

Conditions of Use

As a temporary cover measure, mulch should be used:

- For less than 30 days on disturbed areas that require cover.
- At all times for seeded areas, especially during the wet season and during the hot summer months.
- During the wet season on slopes steeper than 3H:1V with more than 10 feet of vertical relief.

Mulch may be applied at any time of the year and must be refreshed periodically.

For seeded areas, mulch may be made up of 100 percent:

- cottonseed meal;
- fibers made of wood, recycled cellulose, hemp, or kenaf;

- compost;
- or blends of these.

Tackifier shall be plant-based, such as guar or alpha plantago, or chemical-based such as polyacrylamide or polymers.

Generally, mulches come in 40-50 pound bags. Seed and fertilizer are added at time of application.

Recycled cellulose may contain polychlorinated biphenyl (PCBs). Ecology recommends that products should be evaluated for PCBs prior to use.

Refer to BMP C126: Polyacrylamide (PAM) for Soil Erosion Protection for conditions of use. PAM shall not be directly applied to water or allowed to enter a water body.

Any mulch or tackifier product used shall be installed per the manufacturer's instructions.

Design and Installation Specifications

For mulch materials, application rates, and specifications, see Table II-3.6: Mulch Standards and Guidelines. Consult with the local supplier or the local conservation district for their recommendations. Increase the application rate until the ground is 95% covered (i.e. not visible under the mulch layer). Note: Thickness may be increased for disturbed areas in or near sensitive areas or other areas highly susceptible to erosion.

Where the option of "Compost" is selected, it should be a coarse compost that meets the size gradations listed in Table II-3.5: Size Gradations of Compost as Mulch Material when tested in accordance with Test Method 02.02-B found in *Test Methods for the Examination of Composting and Compost* (Thompson, 2001).

Table II-3.5: Size Gradations of Compost as Mulch Material

Sieve Size	Percent Passing
3"	100%
1"	90% - 100%
3/4"	70% - 100%
1/4"	40% - 100%

Mulch used within the ordinary high-water mark of surface waters should be selected to minimize potential flotation of organic matter. Composted organic materials have higher specific gravities (densities) than straw, wood, or chipped material. Consult the Hydraulic Permit Authority (HPA) for mulch mixes if applicable.

Maintenance Standards

The thickness of the mulch cover must be maintained.

Any areas that experience erosion shall be remulched and/or protected with a net or blanket. If the erosion problem is drainage related, then the problem shall be fixed and the eroded area remulched.

Table II-3.6: Mulch Standards and Guidelines

Mulch Material	Guideline	Description
Straw	**Quality Standards**	Air-dried; free from undesirable seed and coarse material.
	Application Rates	2"-3" thick; 5 bales per 1,000 sf or 2-3 tons per acre
	Remarks	Cost-effective protection when applied with adequate thickness. Hand-application generally requires greater thickness than blown straw. The thickness of straw may be reduced by half when used in conjunction with seeding. In windy areas straw must be held in place by crimping, using a tackifier, or covering with netting. Blown straw always has to be held in place with a tackifier as even light winds will blow it away. Straw, however, has several deficiencies that should be considered when selecting mulch materials. It often introduces and/or encourages the propagation of weed species and it has no significant long-term benefits It should also not be used within the ordinary high-water elevation of surface waters (due to flotation).
Hydromulch	**Quality Standards**	No growth inhibiting factors.
	Application Rates	Approx. 35-45 lbs per 1,000 sf or 1,500 - 2,000 lbs per acre
	Remarks	Shall be applied with hydromulcher. Shall not be used without seed and tackifier unless the application rate is at least doubled. Fibers longer than about 3/4 - 1 inch clog hydromulch equipment. Fibers should be kept to less than 3/4 inch.
Compost	**Quality Standards**	No visible water or dust during handling. Must be produced per WAC 173-350, Solid Waste Handling Standards, but may have up to 35% biosolids.
	Application Rates	2" thick min.; approx. 100 tons per acre (approx. 750 lbs per cubic yard)
	Remarks	More effective control can be obtained by increasing thickness to 3". Excellent mulch for protecting final grades until landscaping because it can be directly seeded or tilled into soil as an amendment. Compost used for mulch has a coarser size gradation than compost used for BMP C125: Topsoiling / Composting or BMP T5.13: Post-Construction Soil Quality and Depth. It is more stable and practical to use in wet areas and during rainy weather conditions. Do not use near wetlands or near phosphorous impaired water bodies.
Chipped Site Vegetation	**Quality Standards**	Gradations from fines to 6 inches in length for texture, variation, and interlocking properties. Include a mix of various sizes so that the average size is between 2- and 4- inches.
	Application Rates	2" thick min.;

Table II-3.6: Mulch Standards and Guidelines (continued)

Mulch Material	Guideline	Description
	Remarks	This is a cost-effective way to dispose of debris from clearing and grubbing, and it eliminates the problems associated with burning. Generally, it should not be used on slopes above approx. 10% because of its tendency to be transported by runoff. It is not recommended within 200 feet of surface waters. If permanent seeding or planting is expected shortly after mulch, the decomposition of the chipped vegetation may tie up nutrients important to grass establishment. Note: thick application of this material over existing grass, herbaceous species, and some groundcovers could smother and kill vegetation.
Wood-Based Mulch	**Quality Standards**	No visible water or dust during handling. Must be purchased from a supplier with a Solid Waste Handling Permit or one exempt from solid waste regulations.
	Application Rates	2" thick min.; approx. 100 tons per acre (approx. 750 lbs. per cubic yard)
	Remarks	This material is often called "wood straw" or "hog fuel". The use of mulch ultimately improves the organic matter in the soil. Special caution is advised regarding the source and composition of wood-based mulches. Its preparation typically does not provide any weed seed control, so evidence of residual vegetation in its composition or known inclusion of weed plants or seeds should be monitored and prevented (or minimized).
Wood Strand Mulch	**Quality Standards**	A blend of loose, long, thin wood pieces derived from native conifer or deciduous trees with high length-to-width ratio.
	Application Rates	2" thick min.
	Remarks	Cost-effective protection when applied with adequate thickness. A minimum of 95-percent of the wood strand shall have lengths between 2 and 10-inches, with a width and thickness between 1/16 and 1/2-inches. The mulch shall not contain resin, tannin, or other compounds in quantities that would be detrimental to plant life. Sawdust or wood shavings shall not be used as mulch. [Specification 9-14.4(4) from the *Standard Specifications for Road, Bridge, and Municipal Construction* (WSDOT, 2016)

BMP C122: Nets and Blankets

Purpose

Erosion control nets and blankets are intended to prevent erosion and hold seed and mulch in place on steep slopes and in channels so that vegetation can become well established. In addition, some nets and blankets can be used to permanently reinforce turf to protect drainage ways during high flows.

Nets (commonly called matting) are strands of material woven into an open, but high-tensile strength net (for example, coconut fiber matting). Blankets are strands of material that are not tightly woven, but instead form a layer of interlocking fibers, typically held together by a biodegradable or photodegradable netting (for example, excelsior or straw blankets). They generally have lower tensile strength than nets, but cover the ground more completely. Coir (coconut fiber) fabric comes as both nets and blankets.

Conditions of Use

Erosion control netting and blankets shall be made of natural plant fibers unaltered by synthetic materials.

Erosion control nets and blankets should be used:

- To aid permanent vegetated stabilization of slopes 2H:1V or greater and with more than 10 feet of vertical relief.
- For drainage ditches and swales (highly recommended). The application of appropriate netting or blanket to drainage ditches and swales can protect bare soil from channelized runoff while vegetation is established. Nets and blankets also can capture a great deal of sediment due to their open, porous structure. Nets and blankets can be used to permanently stabilize channels and may provide a cost-effective, environmentally preferable alternative to riprap.

Disadvantages of nets and blankets include:

- Surface preparation is required.
- On slopes steeper than 2.5H:1V, net and blanket installers may need to be roped and harnessed for safety.
- They cost at least $4,000-6,000 per acre installed.

Advantages of nets and blankets include:

- Installation without mobilizing special equipment.
- Installation by anyone with minimal training
- Installation in stages or phases as the project progresses.
- Installers can hand place seed and fertilizer as they progress down the slope.
- Installation in any weather.
- There are numerous types of nets and blankets that can be designed with various parameters in mind. Those parameters include: fiber blend, mesh strength, longevity, biodegradability, cost, and availability.

An alternative to nets and blankets in some limited conditions is BMP C202: Riprap Channel Lining. Ensure that BMP C202: Riprap Channel Lining is appropriate before using it as a substitute for nets and blankets.

Design and Installation Specifications

- See Figure II-3.3: Channel Installation (Clackamas County et al., 2008) and Figure II-3.4: Slope Installation for typical orientation and installation of nets and blankets used in channels and as slope protection. Note: these are typical only; all nets and blankets must be installed per manufacturer's installation instructions.
- Installation is critical to the effectiveness of these products. If good ground contact is not achieved, runoff can concentrate under the product, resulting in significant erosion.
- Installation of nets and blankets on slopes:
    1. Complete final grade and track walk up and down the slope.
    2. Install hydromulch with seed and fertilizer.
    3. Dig a small trench, approximately 12 inches wide by 6 inches deep along the top of the slope.
    4. Install the leading edge of the net/blanket into the small trench and staple approximately every 18 inches. NOTE: Staples are metal, "U"-shaped, and a minimum of 6 inches long. Longer staples are used in sandy soils. Biodegradable stakes are also available.
    5. Roll the net/blanket slowly down the slope as the installer walks backward. NOTE: The net/blanket rests against the installer's legs. Staples are installed as the net/blanket is unrolled. It is critical that the proper staple pattern is used for the net/blanket being installed. The net/blanket is not to be allowed to roll down the slope on its own as this stretches the net/blanket, making it impossible to maintain soil contact. In addition, no one is allowed to walk on the net/blanket after it is in place.
    6. If the net/blanket is not long enough to cover the entire slope length, the trailing edge of the upper net/blanket should overlap the leading edge of the lower net/blanket and be stapled. On steeper slopes, this overlap should be installed in a small trench, stapled, and covered with soil.
- With the variety of products available, it is impossible to cover all the details of appropriate use and installation. Therefore, it is critical that the designer consult the manufacturer's information and that a site visit takes place in order to ensure that the product specified is appropriate. Information is also available in WSDOT's *Standard Specifications for Road, Bridge, and Municipal Construction* Division 8-01 and Division 9-14 (WSDOT, 2016).
- Use jute matting in conjunction with mulch (BMP C121: Mulching). Excelsior, woven straw blankets and coir (coconut fiber) blankets may be installed without mulch. There are many other types of erosion control nets and blankets on the market that may be appropriate in certain circumstances.
- In general, most nets (e.g., jute matting) require mulch in order to prevent erosion because they have a fairly open structure. Blankets typically do not require mulch because they usually provide complete protection of the surface.
- Extremely steep, unstable, wet, or rocky slopes are often appropriate candidates for use of synthetic blankets, as are riverbanks, beaches and other high-energy environments. If

synthetic blankets are used, the soil should be hydromulched first.

- 100-percent biodegradable blankets are available for use in sensitive areas. These organic blankets are usually held together with a paper or fiber mesh and stitching which may last up to a year.
- Most netting used with blankets is photodegradable, meaning it breaks down under sunlight (not UV stabilized). However, this process can take months or years even under bright sun. Once vegetation is established, sunlight does not reach the mesh. It is not uncommon to find non-degraded netting still in place several years after installation. This can be a problem if maintenance requires the use of mowers or ditch cleaning equipment. In addition, birds and small animals can become trapped in the netting.

Maintenance Standards

- Maintain good contact with the ground. Erosion must not occur beneath the net or blanket.
- Repair and staple any areas of the net or blanket that are damaged or not in close contact with the ground.
- Fix and protect eroded areas if erosion occurs due to poorly controlled drainage.

Figure II-3.3: Channel Installation


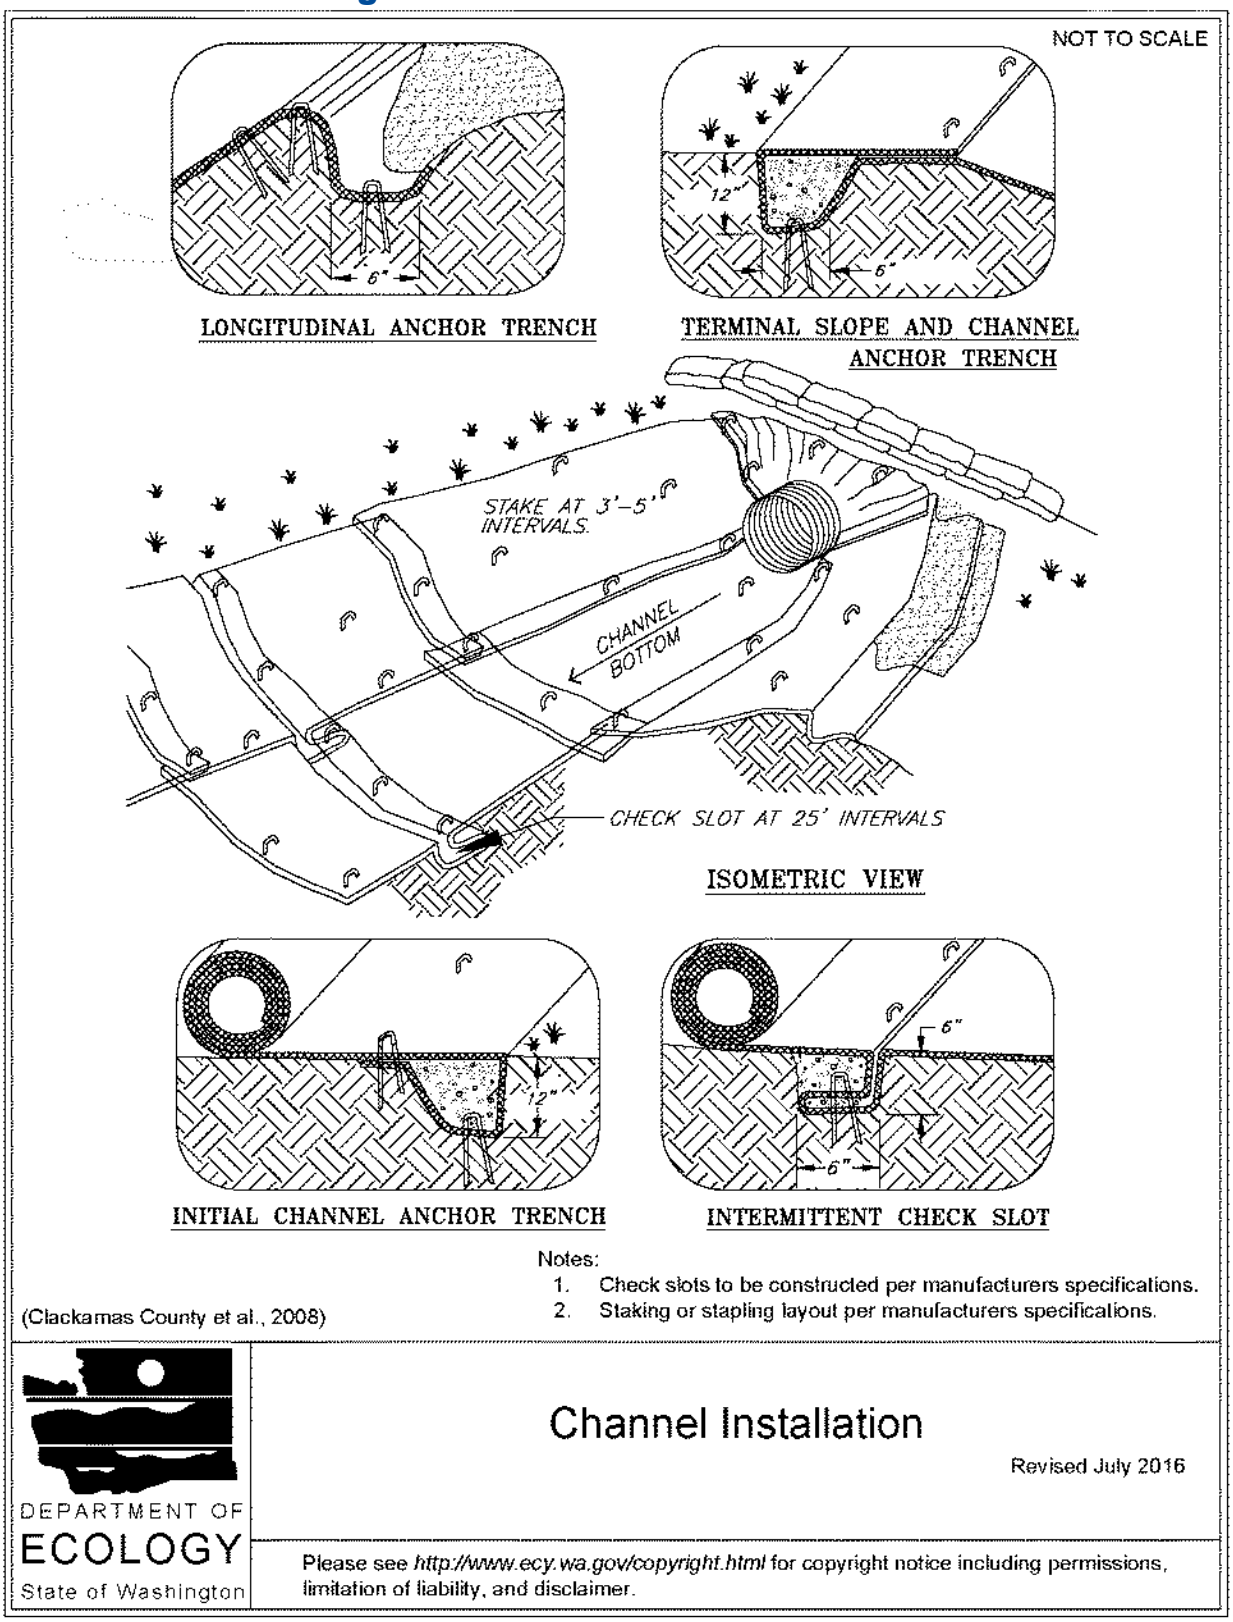


Figure II-3.4: Slope Installation

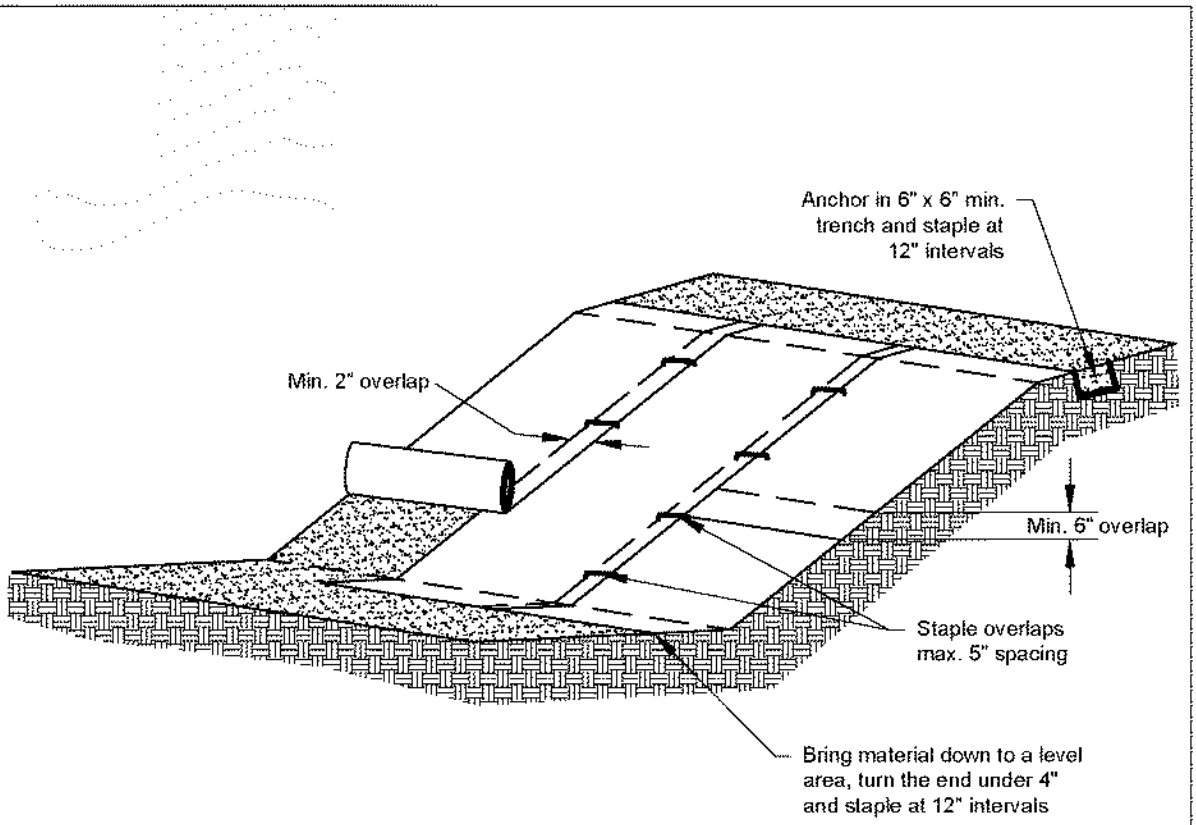

Notes:

1. Slope surface shall be smooth before placement for proper soil contact.
2. Stapling pattern as per manufacturer's recommendations.
3. Do not stretch blankets/mattings tight - allow the rolls to mold to any irregularities.
4. For slopes less than 3H:1V, rolls may be placed in horizontal strips.
5. If there is a berm at the top of the slope, anchor upslope of the berm.
6. Lime, fertilize, and seed before installation. Planting of shrubs, trees, etc. should occur after installation.

NOT TO SCALE

DEPARTMENT OF ECOLOGY
State of Washington

Slope Installation

Revised June 2016

Please see *http://www.ecy.wa.gov/copyright.html* for copyright notice including permissions, limitation of liability, and disclaimer.

BMP C123: Plastic Covering

Purpose

Plastic covering provides immediate, short-term erosion protection to slopes and disturbed areas.

Conditions of Use

Plastic covering may be used on disturbed areas that require cover measures for less than 30 days, except as stated below.

- Plastic is particularly useful for protecting cut and fill slopes and stockpiles. However, the relatively rapid breakdown of most polyethylene sheeting makes it unsuitable for applications greater than six months.
- Due to rapid runoff caused by plastic covering, do not use this method upslope of areas that might be adversely impacted by concentrated runoff. Such areas include steep and/or unstable slopes.
- Plastic sheeting may result in increased runoff volumes and velocities, requiring additional on-site measures to counteract the increases. Creating a trough with wattles or other material can convey clean water away from these areas.
- To prevent undercutting, trench and backfill rolled plastic covering products.
- Although the plastic material is inexpensive to purchase, the cost of installation, maintenance, removal, and disposal add to the total costs of this BMP.
- Whenever plastic is used to protect slopes, install water collection measures at the base of the slope. These measures include plastic-covered berms, channels, and pipes used to convey clean rainwater away from bare soil and disturbed areas. Do not mix clean runoff from a plastic covered slope with dirty runoff from a project.
- Other uses for plastic include:
    - Temporary ditch liner.
    - Pond liner in temporary sediment pond.
    - Liner for bermed temporary fuel storage area if plastic is not reactive to the type of fuel being stored.
    - Emergency slope protection during heavy rains.
    - Temporary drainpipe (“elephant trunk”) used to direct water.

Design and Installation Specifications

- Plastic slope cover must be installed as follows:
    1. Run plastic up and down the slope, not across the slope.
    2. Plastic may be installed perpendicular to a slope if the slope length is less than 10 feet.

3. Provide a minimum of 8-inch overlap at the seams.
4. On long or wide slopes, or slopes subject to wind, tape all seams.
5. Place plastic into a small (12-inch wide by 6-inch deep) slot trench at the top of the slope and backfill with soil to keep water from flowing underneath.
6. Place sand filled burlap or geotextile bags every 3 to 6 feet along seams and tie them together with twine to hold them in place.
7. Inspect plastic for rips, tears, and open seams regularly and repair immediately. This prevents high velocity runoff from contacting bare soil, which causes extreme erosion.
8. Sandbags may be lowered into place tied to ropes. However, all sandbags must be staked in place.

- Plastic sheeting shall have a minimum thickness of 0.06 millimeters.
- If erosion at the toe of a slope is likely, a gravel berm, riprap, or other suitable protection shall be installed at the toe of the slope in order to reduce the velocity of runoff.

Maintenance Standards

- Torn sheets must be replaced and open seams repaired.
- Completely remove and replace the plastic if it begins to deteriorate due to ultraviolet radiation.
- Completely remove plastic when no longer needed.
- Dispose of old tires used to weight down plastic sheeting appropriately.

Approved as Functionally Equivalent

Ecology has approved products as able to meet the requirements of this BMP. The products did not pass through the Technology Assessment Protocol – Ecology (TAPE) process. Local jurisdictions may choose not to accept these products, or may require additional testing prior to consideration for local use. Products that Ecology has approved as functionally equivalent are available for review on Ecology's website at:

https://ecology.wa.gov/Regulations-Permits/Guidance-technical-assistance/Stormwater-permittee-guidance-resources/Emerging-stormwater-treatment-technologies

BMP C124: Sodding

Purpose

The purpose of sodding is to establish turf for immediate erosion protection and to stabilize drainage paths where concentrated overland flow will occur.

Conditions of Use

Sodding may be used in the following areas:

- Disturbed areas that require short-term or long-term cover.
- Disturbed areas that require immediate vegetative cover.
- All waterways that require vegetative lining. Waterways may also be seeded rather than sodded, and protected with a net or blanket.

Design and Installation Specifications

Sod shall be free of weeds, of uniform thickness (approximately 1-inch thick), and shall have a dense root mat for mechanical strength.

The following steps are recommended for sod installation:

1. Shape and smooth the surface to final grade in accordance with the approved grading plan. Consider any areas (such as swales) that need to be overexcavated below design elevation to allow room for placing soil amendment and sod.
2. Amend 4 inches (minimum) of compost into the top 8 inches of the soil if the organic content of the soil is less than ten percent or the permeability is less than 0.6 inches per hour. See https://ecology.wa.gov/Waste-Toxics/Reducing-recycling-waste/Organic-materials/Managing-organics-compost for further information.
3. Fertilize according to the sod supplier's recommendations.
4. Work lime and fertilizer 1 to 2 inches into the soil, and smooth the surface.
5. Lay strips of sod beginning at the lowest area to be sodded and perpendicular to the direction of water flow. Wedge strips securely into place. Square the ends of each strip to provide for a close, tight fit. Stagger joints at least 12 inches. Staple on slopes steeper than 3H:1V. Staple the upstream edge of each sod strip.
6. Roll the sodded area and irrigate.
7. When sodding is carried out in alternating strips or other patterns, seed the areas between the sod immediately after sodding.

Maintenance Standards

If the grass is unhealthy, the cause shall be determined and appropriate action taken to reestablish a healthy groundcover. If it is impossible to establish a healthy groundcover due to frequent saturation, instability, or some other cause, the sod shall be removed, the area seeded with an appropriate mix, and protected with a net or blanket.

BMP C125: Topsoiling / Composting

Purpose

Topsoiling and composting provide a suitable growth medium for final site stabilization with vegetation. While not a permanent cover practice in itself, topsoiling and composting are an integral component of providing permanent cover in those areas where there is an unsuitable soil surface for plant growth. Use this BMP in conjunction with other BMPs such as BMP C120: Temporary and Permanent Seeding, BMP C121: Mulching, or BMP C124: Sodding. Implementation of this BMP may meet the post-construction requirements of BMP T5.13: Post-Construction Soil Quality and Depth.

Native soils and disturbed soils that have been organically amended not only retain much more stormwater, but also serve as effective biofilters for urban pollutants and, by supporting more vigorous plant growth, reduce the water, fertilizer and pesticides needed to support installed landscapes. Topsoil does not include any subsoils but only the material from the top several inches including organic debris.

Conditions of Use

- Permanent landscaped areas shall contain healthy topsoil that reduces the need for fertilizers, improves overall topsoil quality, provides for better vegetative health and vitality, improves hydrologic characteristics, and reduces the need for irrigation.
- Leave native soils and the duff layer undisturbed to the maximum extent practicable. Stripping of existing, properly functioning soil system and vegetation for the purpose of topsoiling during construction is not acceptable. Preserve existing soil systems in undisturbed and uncompacted conditions if functioning properly.
- Areas that already have good topsoil, such as undisturbed areas, do not require soil amendments.
- Restore, to the maximum extent practical, native soils disturbed during clearing and grading to a condition equal to or better than the original site condition's moisture-holding capacity. Use on-site native topsoil, incorporate amendments into on-site soil, or import blended topsoil to meet this requirement.
- Topsoiling is a required procedure when establishing vegetation on shallow soils, and soils of critically low pH (high acid) levels.
- Beware of where the topsoil comes from, and what vegetation was on site before disturbance. Invasive plant seeds may be included and could cause problems for establishing native plants, landscaped areas, or grasses.
- Topsoil from the site will contain mycorrhizal bacteria that are necessary for healthy root growth and nutrient transfer. These native mycorrhiza are acclimated to the site and will provide optimum conditions for establishing grasses. Use commercially available mycorrhiza products when using off-site topsoil.

Design and Installation Specifications

Meet the following requirements for disturbed areas that will be developed as lawn or landscaped areas at the completed project site:

- Maximize the depth of the topsoil wherever possible to provide the maximum possible infiltration capacity and beneficial growth medium. Topsoil shall have:
    - A minimum depth of 8-inches. Scarify subsoils below the topsoil layer at least 4-inches with some incorporation of the upper material to avoid stratified layers, where feasible. Ripping or re-structuring the subgrade may also provide additional benefits regarding the overall infiltration and interflow dynamics of the soil system.
    - A minimum organic content of 10% dry weight in planting beds, and 5% organic matter content in turf areas. Incorporate organic amendments to a minimum 8-inch depth except where tree roots or other natural features limit the depth of incorporation.
    - A pH between 6.0 and 8.0 or matching the pH of the undisturbed soil.
    - If blended topsoil is imported, then fines should be limited to 25 percent passing through a 200 sieve.
- Mulch planting beds with 2 inches of organic material
- Accomplish the required organic content, depth, and pH by returning native topsoil to the site, importing topsoil of sufficient organic content, and/or incorporating organic amendments. When using the option of incorporating amendments to meet the organic content requirement, use compost that meets the compost specification for Bioretention (See BMP T7.30: Bioretention), with the exception that the compost may have up to 35% biosolids or manure.
- Sections 3 through 7 of *Building Soil: Guidelines and Resources for Implementing Soil Quality and Depth BMP T5.13 in WDOE Stormwater Management Manual for Western Washington* (Stenn et al., 2016), provides useful guidance for implementing whichever option is chosen. It includes guidance for pre-approved default strategies and guidance for custom strategies. Check with your local jurisdiction concerning its acceptance of this guidance.
- The final composition and construction of the soil system will result in a natural selection or favoring of certain plant species over time. For example, incorporation of topsoil may favor grasses, while layering with mildly acidic, high-carbon amendments may favor more woody vegetation.
- Allow sufficient time in scheduling for topsoil spreading prior to seeding, sodding, or planting.
- Take care when applying top soil to subsoils with contrasting textures. Sandy topsoil over clayey subsoil is a particularly poor combination, as water creeps along the junction between the soil layers and causes the topsoil to slough. If topsoil and subsoil are not properly bonded, water will not infiltrate the soil profile evenly and it will be difficult to establish vegetation. The best method to promote bonding is to actually work the topsoil into the layer below for a depth of at least 6 inches.
- Field exploration of the site shall be made to determine if there is surface soil of sufficient quantity and quality to justify stripping. Topsoil shall be friable and loamy (loam, sandy loam,

silt loam, sandy clay loam, and clay loam). Avoid areas of natural ground water recharge.

- Stripping shall be confined to the immediate construction area. A 4-inch to 6-inch stripping depth is common, but depth may vary depending on the particular soil. All surface runoff control structures shall be in place prior to stripping.
- Do not place topsoil while in a frozen or muddy condition, when the subgrade is excessively wet, or when conditions exist that may otherwise be detrimental to proper grading or proposed sodding or seeding.
- In any areas requiring grading, remove and stockpile the duff layer and topsoil on site in a designated, controlled area, not adjacent to public resources and critical areas. Reapply stockpiled topsoil to other portions of the site where feasible.
- Locate the topsoil stockpile so that it meets specifications and does not interfere with work on the site. It may be possible to locate more than one pile in proximity to areas where topsoil will be used.
- Stockpiling of topsoil shall occur in the following manner:
    - Side slopes of the stockpile shall not exceed 2H:1V.
    - Between October 1 and April 30:
        - An interceptor dike with gravel outlet and silt fence shall surround all topsoil.
        - Within 2 days complete erosion control seeding, or covering stockpiles with clear plastic, or other mulching materials.
    - Between May 1 and September 30:
        - An interceptor dike with gravel outlet and silt fence shall surround all topsoil if the stockpile will remain in place for a longer period of time than active construction grading.
        - Within 7 days complete erosion control seeding, or covering stockpiles with clear plastic, or other mulching materials.
- When native topsoil is to be stockpiled and reused the following should apply to ensure that the mycorrhizal bacterial, earthworms, and other beneficial organisms will not be destroyed:
    - Re-install topsoil within 4 to 6 weeks.
    - Do not allow the saturation of topsoil with water.
    - Do not use plastic covering.

Maintenance Standards

- Inspect stockpiles regularly, especially after large storm events. Stabilize any areas that have eroded.
- Establish soil quality and depth toward the end of construction and once established, protect from compaction, such as from large machinery use, and from erosion.

BMP C154: Concrete Washout Area

Purpose

Prevent or reduce the discharge of pollutants from concrete waste to stormwater by conducting washout off-site, or performing on-site washout in a designated area.

Conditions of Use

Concrete washout areas are implemented on construction projects where:

- Concrete is used as a construction material
- It is not possible to dispose of all concrete wastewater and washout off-site (ready mix plant, etc.).
- Concrete truck drums are washed on-site.

  Note that auxiliary concrete truck components (e.g. chutes and hoses) and small concrete handling equipment (e.g. hand tools, screeds, shovels, rakes, floats, trowels, and wheel-barrows) may be washed into formed areas awaiting concrete pour.

At no time shall concrete be washed off into the footprint of an area where an infiltration feature will be installed.

Design and Installation Specifications

Implementation

- Perform washout of concrete truck drums at an approved off-site location or in designated concrete washout areas only.
- Do not wash out concrete onto non-formed areas, or into storm drains, open ditches, streets, or streams.
- Wash equipment difficult to move, such as concrete paving machines, in areas that do not directly drain to natural or constructed stormwater conveyance or potential infiltration areas.
- Do not allow excess concrete to be dumped on-site, except in designated concrete washout areas as allowed above.
- Concrete washout areas may be prefabricated concrete washout containers, or self-installed structures (above-grade or below-grade).
- Prefabricated containers are most resistant to damage and protect against spills and leaks. Companies may offer delivery service and provide regular maintenance and disposal of solid and liquid waste.
- If self-installed concrete washout areas are used, below-grade structures are preferred over above-grade structures because they are less prone to spills and leaks.
- Self-installed above-grade structures should only be used if excavation is not practical.
- Concrete washout areas shall be constructed and maintained in sufficient quantity and size to contain all liquid and concrete waste generated by washout operations.

Education

- Discuss the concrete management techniques described in this BMP with the ready-mix concrete supplier before any deliveries are made.
- Educate employees and subcontractors on the concrete waste management techniques described in this BMP.
- Arrange for the contractor's superintendent or Certified Erosion and Sediment Control Lead (CESCL) to oversee and enforce concrete waste management procedures.
- A sign should be installed adjacent to each concrete washout area to inform concrete equipment operators to utilize the proper facilities.

Contracts

Incorporate requirements for concrete waste management into concrete supplier and subcontractor agreements.

Location and Placement

- Locate concrete washout areas at least 50 feet from sensitive areas such as storm drains, open ditches, water bodies, or wetlands.
- Allow convenient access to the concrete washout area for concrete trucks, preferably near the area where the concrete is being poured.
- If trucks need to leave a paved area to access the concrete washout area, prevent track-out with a pad of rock or quarry spalls (see BMP C105: Stabilized Construction Access). These areas should be far enough away from other construction traffic to reduce the likelihood of accidental damage and spills.
- The number of concrete washout areas you install should depend on the expected demand for storage capacity.
- On large sites with extensive concrete work, concrete washout areas should be placed in multiple locations for ease of use by concrete truck drivers.

Concrete Truck Washout Procedures

- Washout of concrete truck drums shall be performed in designated concrete washout areas only.
- Concrete washout from concrete pumper bins can be washed into concrete pumper trucks and discharged into designated concrete washout areas or properly disposed of off-site.

Concrete Washout Area Installation

- Concrete washout areas should be constructed as shown in the figures below, with a recommended minimum length and minimum width of 10 ft, but with sufficient quantity and volume to contain all liquid and concrete waste generated by washout operations.
- Plastic lining material should be a minimum of 10 mil polyethylene sheeting and should be free of holes, tears, or other defects that compromise the impermeability of the material.
- Lath and flagging should be commercial type.
- Liner seams shall be installed in accordance with manufacturers' recommendations.
- Soil base shall be prepared free of rocks or other debris that may cause tears or holes in the plastic lining material.

Maintenance Standards

Inspection and Maintenance

- Inspect and verify that concrete washout areas are in place prior to the commencement of concrete work.
- Once concrete wastes are washed into the designated washout area and allowed to harden,

the concrete should be broken up, removed, and disposed of per applicable solid waste regulations. Dispose of hardened concrete on a regular basis.

- During periods of concrete work, inspect the concrete washout areas daily to verify continued performance.
    - Check overall condition and performance.
    - Check remaining capacity (% full).
    - If using self-installed concrete washout areas, verify plastic liners are intact and sidewalls are not damaged.
    - If using prefabricated containers, check for leaks.
- Maintain the concrete washout areas to provide adequate holding capacity with a minimum freeboard of 12 inches.
- Concrete washout areas must be cleaned, or new concrete washout areas must be constructed and ready for use once the concrete washout area is 75% full.
- If the concrete washout area is nearing capacity, vacuum and dispose of the waste material in an approved manner.
    - Do not discharge liquid or slurry to waterways, storm drains or directly onto ground.
    - Do not discharge to the sanitary sewer without local approval.
    - Place a secure, non-collapsing, non-water collecting cover over the concrete washout area prior to predicted wet weather to prevent accumulation and overflow of precipitation.
    - Remove and dispose of hardened concrete and return the structure to a functional condition. Concrete may be reused on-site or hauled away for disposal or recycling.
- When you remove materials from a self-installed concrete washout area, build a new structure; or, if the previous structure is still intact, inspect for signs of weakening or damage, and make any necessary repairs. Re-line the structure with new plastic after each cleaning.

Removal of Concrete Washout Areas

- When concrete washout areas are no longer required for the work, the hardened concrete, slurries and liquids shall be removed and properly disposed of.
- Materials used to construct concrete washout areas shall be removed from the site of the work and disposed of or recycled.
- Holes, depressions or other ground disturbance caused by the removal of the concrete washout areas shall be backfilled, repaired, and stabilized to prevent erosion.

Figure II-3.7: Concrete Washout Area with Wood Planks

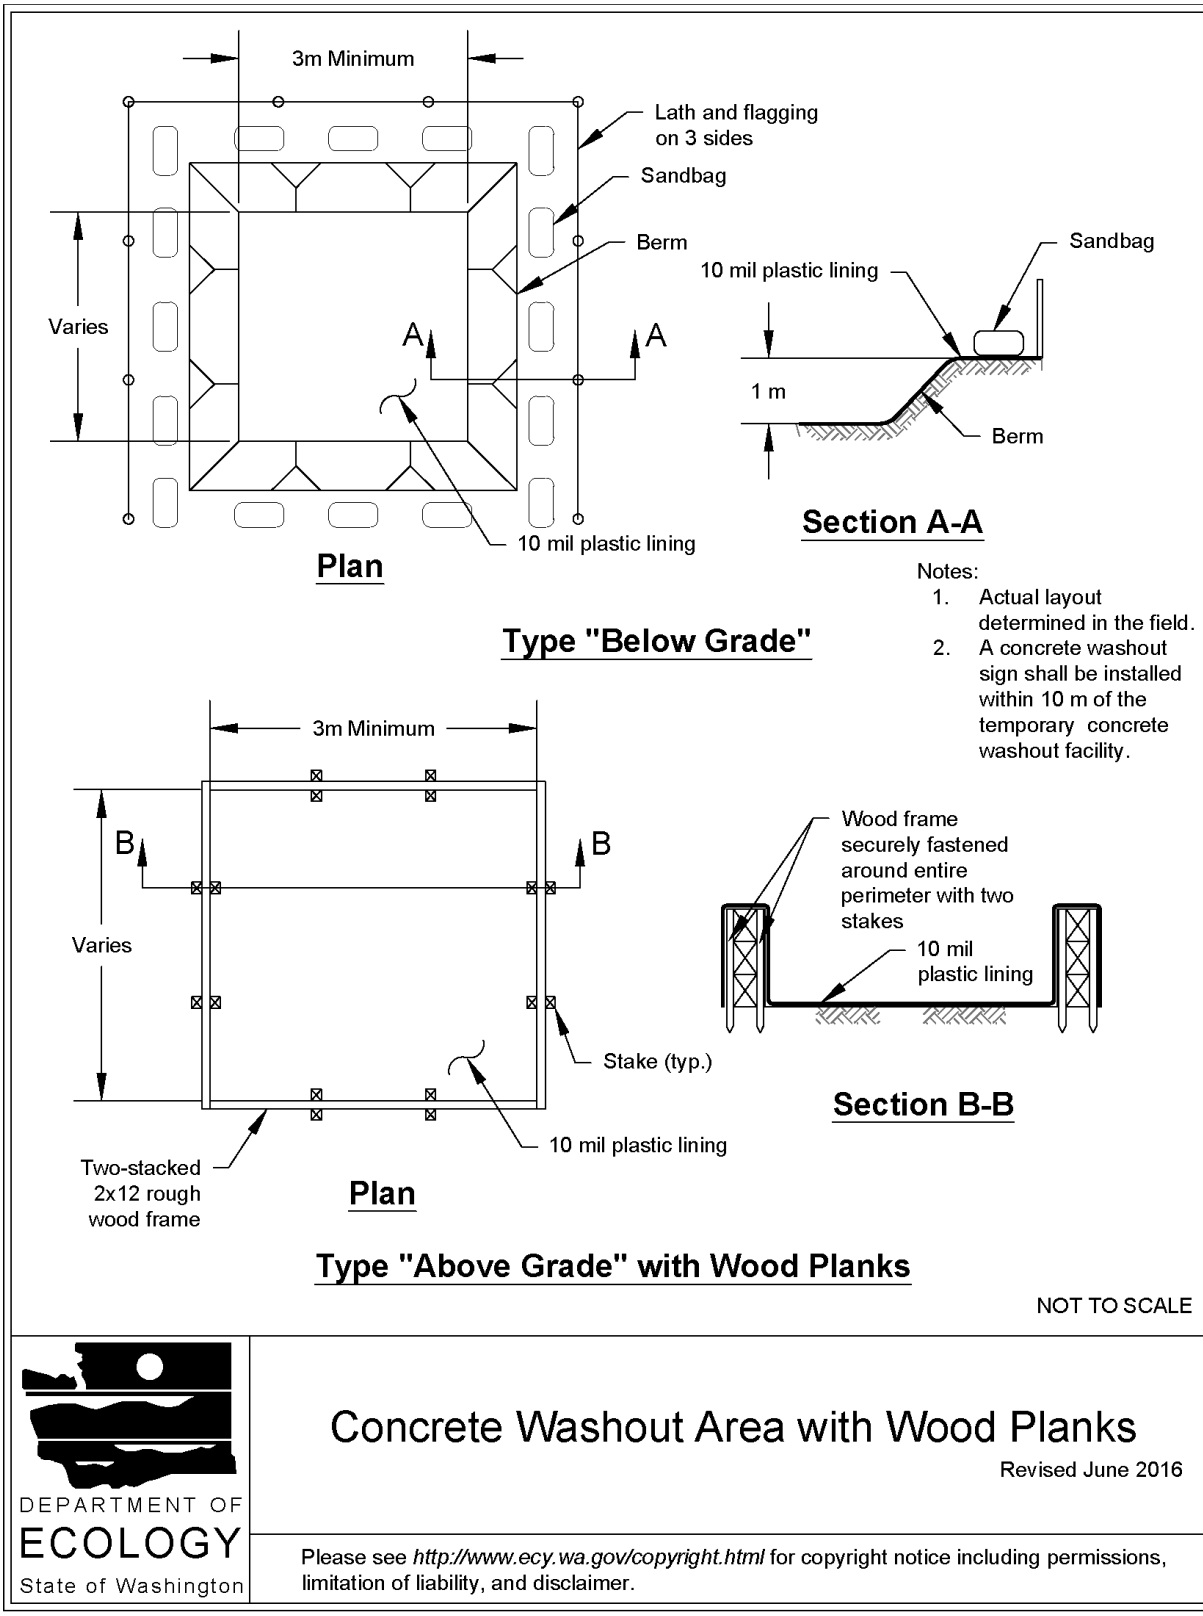


Figure II-3.8: Concrete Washout Area with Straw Bales


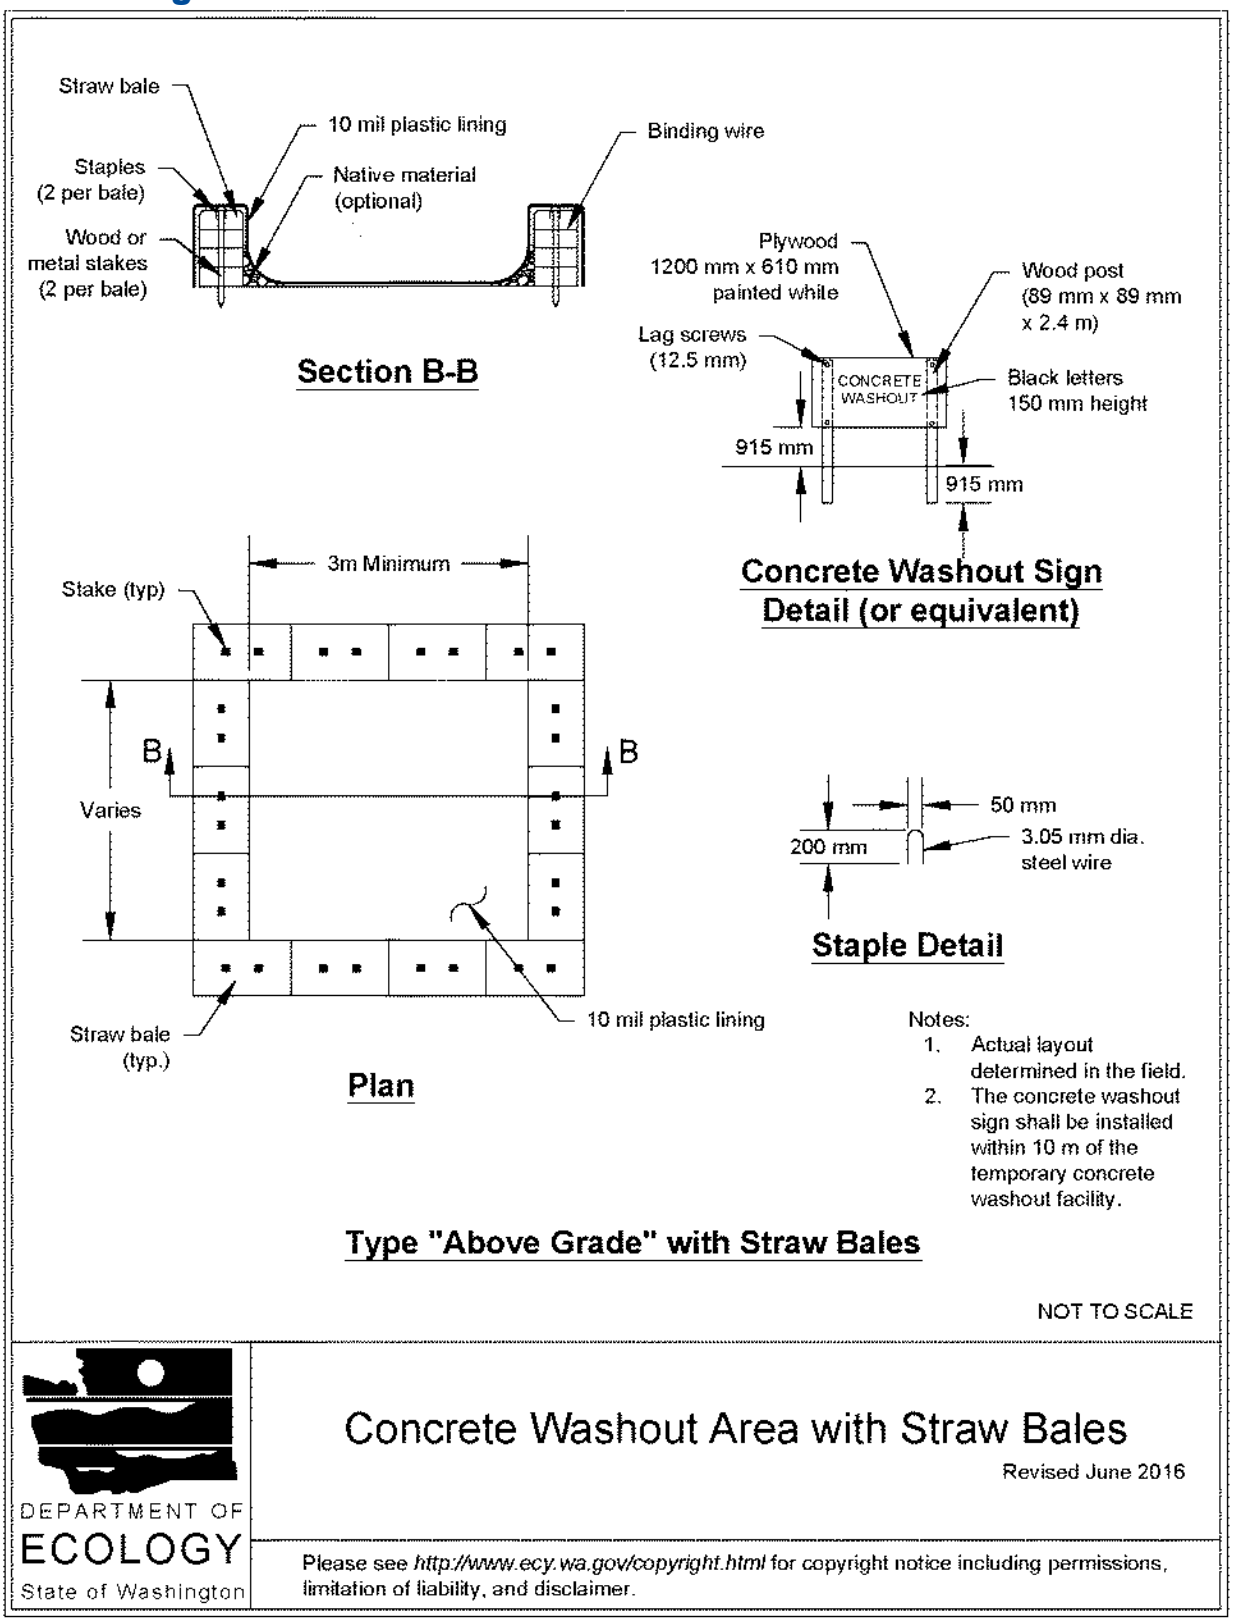


Figure II-3.9: Prefabricated Concrete Washout Container w/Ramp

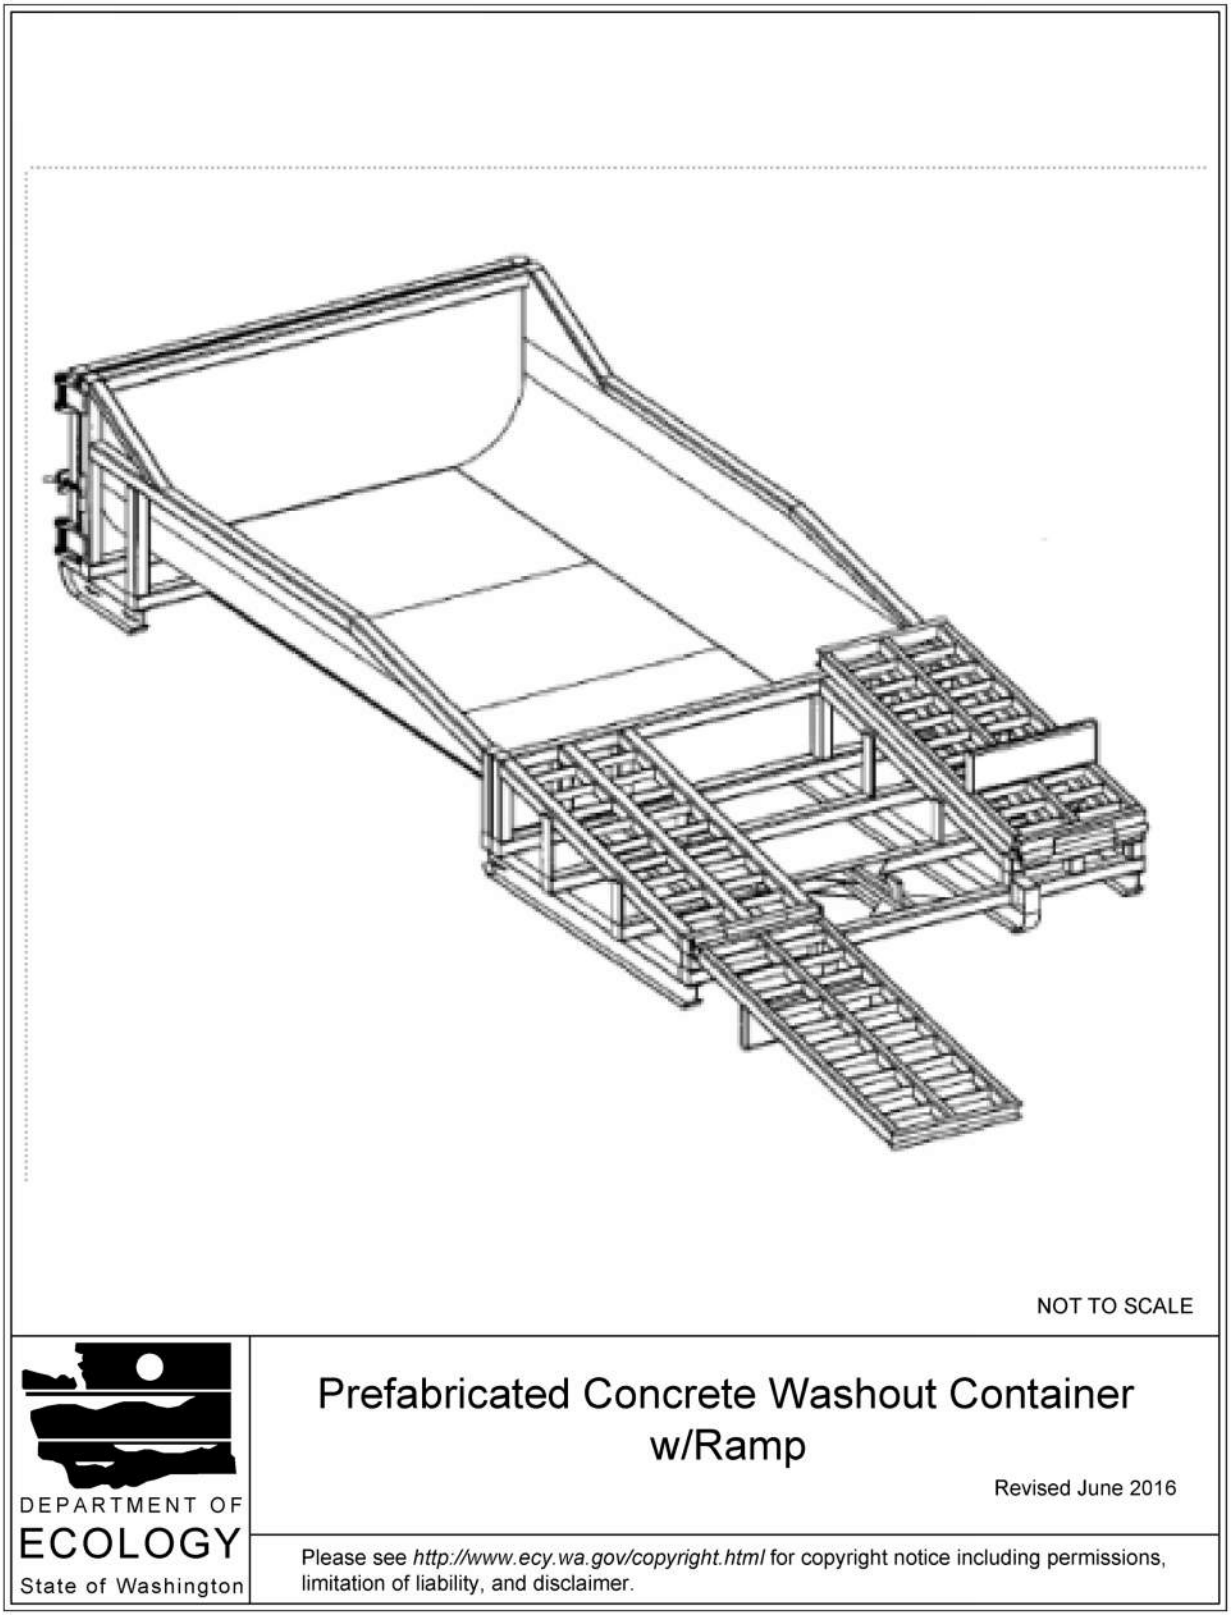

BMP C160: Certified Erosion and Sediment Control Lead

Purpose

The project proponent designates at least one person as the responsible representative in charge of erosion and sediment control (ESC), and water quality protection. The designated person shall be responsible for ensuring compliance with all local, state, and federal erosion and sediment control and water quality requirements. Construction sites one acre or larger that discharge to waters of the State must designate a Certified Erosion and Sediment Control Lead (CESCL) as the responsible representative.

Conditions of Use

A CESCL shall be made available on projects one acre or larger that discharge stormwater to surface waters of the state. Sites less than one acre may have a person without CESCL certification conduct inspections.

The CESCL shall:

- Have a current certificate proving attendance in an erosion and sediment control training course that meets the minimum ESC training and certification requirements established by Ecology.

  Ecology has provided the minimum requirements for CESCL course training, as well as a list of ESC training and certification providers at:

  https://ecology.wa.gov/Regulations-Permits/Permits-certifications/Certified-erosion-sediment-control

  OR

- Be a Certified Professional in Erosion and Sediment Control (CPESC). For additional information go to:

  http://www.envirocertintl.org/cpesc/

Specifications

- CESCL certification shall remain valid for three years.
- The CESCL shall have authority to act on behalf of the contractor or project proponent and shall be available, or on-call, 24 hours per day throughout the period of construction.
- The Construction SWPPP shall include the name, telephone number, fax number, and address of the designated CESCL. See II-2 Construction Stormwater Pollution Prevention Plans (Construction SWPPPs).
- A CESCL may provide inspection and compliance services for multiple construction projects in the same geographic region, but must be on site whenever earthwork activities are

occurring that could generate release of turbid water.

- Duties and responsibilities of the CESCL shall include, but are not limited to the following:
    - Maintaining a permit file on site at all times which includes the Construction SWPPP and any associated permits and plans.
    - Directing BMP installation, inspection, maintenance, modification, and removal.
    - Updating all project drawings and the Construction SWPPP with changes made.
    - Completing any sampling requirements including reporting results using electronic Discharge Monitoring Reports (WebDMR).
    - Facilitate, participate in, and take corrective actions resulting from inspections performed by outside agencies or the owner.
    - Keeping daily logs, and inspection reports. Inspection reports should include:
        - Inspection date/time.
        - Weather information; general conditions during inspection and approximate amount of precipitation since the last inspection.
        - Visual monitoring results, including a description of discharged stormwater. The presence of suspended sediment, turbid water, discoloration, and oil sheen shall be noted, as applicable.
        - Any water quality monitoring performed during inspection.
        - General comments and notes, including a brief description of any BMP repairs, maintenance or installations made as a result of the inspection.
        - A summary or list of all BMPs implemented, including observations of all erosion/sediment control structures or practices. The following shall be noted:
            1. Locations of BMPs inspected.
            2. Locations of BMPs that need maintenance.
            3. Locations of BMPs that failed to operate as designed or intended.
            4. Locations of where additional or different BMPs are required.

BMP C162: Scheduling

Purpose

Sequencing a construction project reduces the amount and duration of soil exposed to erosion by wind, rain, runoff, and vehicle tracking.

Conditions of Use

The construction sequence schedule is an orderly listing of all major land-disturbing activities together with the necessary erosion and sedimentation control measures planned for the project. This type of schedule guides the contractor on work to be done before other work is started so that serious erosion and sedimentation problems can be avoided.

Following a specified work schedule that coordinates the timing of land-disturbing activities and the installation of control measures is perhaps the most cost-effective way of controlling erosion during construction. The removal of ground cover leaves a site vulnerable to erosion. Construction sequencing that limits land clearing, provides timely installation of erosion and sedimentation controls, and restores protective cover quickly can significantly reduce the erosion potential of a site.

Design Considerations

- Minimize construction during rainy periods.
- Schedule projects to disturb only small portions of the site at any one time. Complete grading as soon as possible. Immediately stabilize the disturbed portion before grading the next portion. Practice staged seeding in order to revegetate cut and fill slopes as the work progresses.

II-3.3 Construction Runoff BMPs

BMP C200: Interceptor Dike and Swale

Purpose

Provide a dike of compacted soil or a swale at the top or base of a disturbed slope or along the perimeter of a disturbed construction area to convey stormwater. Use the dike and/or swale to intercept the runoff from unprotected areas and direct it to areas where erosion can be controlled. This can prevent storm runoff from entering the work area or sediment-laden runoff from leaving the construction site.

Conditions of Use

Use an interceptor dike or swale where runoff from an exposed site or disturbed slope must be conveyed to an erosion control BMP which can safely convey the stormwater.

- Locate upslope of a construction site to prevent runoff from entering the disturbed area.
- When placed horizontally across a disturbed slope, it reduces the amount and velocity of runoff flowing down the slope.
- Locate downslope to collect runoff from a disturbed area and direct it to a sediment BMP (e.g. BMP C240: Sediment Trap or BMP C241: Sediment Pond (Temporary)).

Design and Installation Specifications

- Dike and/or swale and channel must be stabilized with temporary or permanent vegetation or other channel protection during construction.
- Steep grades require channel protection and check dams.
- Review construction for areas where overtopping may occur.
- Can be used at the top of new fill before vegetation is established.
- May be used as a permanent diversion channel to carry the runoff.
- Contributing area for an individual dike or swale should be one acre or less.
- Design the dike and/or swale to contain flows calculated by one of the following methods:
    - Single Event Hydrograph Method: The peak volumetric flow rate calculated using a 10-minute time step from a Type 1A, 10-year, 24-hour frequency storm for the worst-case land cover condition.

      OR

    - Continuous Simulation Method: The 10-year peak flow rate, as determined by an approved continuous runoff model with a 15-minute time step for the worst-case land cover condition.

  Worst-case land cover conditions (i.e., producing the most runoff) should be used for analysis (in most cases, this would be the land cover conditions just prior to final landscaping).

Interceptor Dikes

Interceptor dikes shall meet the following criteria:

- Top Width: 2 feet minimum.
- Height: 1.5 feet minimum on berm.
- Side Slope: 2H:1V or flatter.
- Grade: Depends on topography, however, dike system minimum is 0.5%, and maximum is 1%.
- Compaction: Minimum of 90 percent ASTM D698 standard proctor.
- Stabilization: Depends on velocity and reach. Inspect regularly to ensure stability.
- Ground Slopes <5%: Seed and mulch applied within 5 days of dike construction (see BMP C121: Mulching).
- Ground Slopes 5 - 40%: Dependent on runoff velocities and dike materials. Stabilization should be done immediately using either sod or riprap, or other measures to avoid erosion.
- The upslope side of the dike shall provide positive drainage to the dike outlet. No erosion shall

occur at the outlet. Provide energy dissipation measures as necessary. Sediment-laden runoff must be released through a sediment trapping facility.

- Minimize construction traffic over temporary dikes. Use temporary cross culverts for channel crossing.
- See Table II-3.8: Horizontal Spacing of Interceptor Dikes Along Ground Slope for recommended horizontal spacing between dikes.

Table II-3.8: Horizontal Spacing of Interceptor Dikes Along Ground Slope

Average Slope	Slope Percent	Flowpath Length
20H:1V or less	3-5%	300 feet
(10 to 20)H:1V	5-10%	200 feet
(4 to 10)H:1V	10-25%	100 feet
(2 to 4)H:1V	25-50%	50 feet

Interceptor Swales

Interceptor swales shall meet the following criteria:

- Bottom Width: 2 feet minimum; the cross-section bottom shall be level.
- Depth: 1-foot minimum.
- Side Slope: 2H:1V or flatter.
- Grade: Maximum 5 percent, with positive drainage to a suitable outlet (such as BMP C241: Sediment Pond (Temporary)).
- Stabilization: Seed as per BMP C120: Temporary and Permanent Seeding, or BMP C202: Riprap Channel Lining, 12 inches thick riprap pressed into the bank and extending at least 8 inches vertical from the bottom.

Maintenance Standards

- Inspect diversion dikes and interceptor swales once a week and after every rainfall. Immediately remove sediment from the flow area.
- Damage caused by construction traffic or other activity must be repaired before the end of each working day.
- Check outlets and make timely repairs as needed to avoid gully formation. When the area below the temporary diversion dike is permanently stabilized, remove the dike and fill and stabilize the channel to blend with the natural surface.

BMP C207: Check Dams

Purpose

Construction of check dams across a swale or ditch reduces the velocity of concentrated flow and dissipates energy at the check dam.

Conditions of Use

Use check dams where temporary or permanent channels are not yet vegetated, channel lining is infeasible, and/or velocity checks are required.

- Check dams may not be placed in streams unless approved by the State Department of Fish and Wildlife.
- Check dams may not be placed in wetlands without approval from a permitting agency.
- Do not place check dams below the expected backwater from any salmonid bearing water between October 1 and May 31 to ensure that there is no loss of high flow refuge habitat for overwintering juvenile salmonids and emergent salmonid fry.

Design and Installation Specifications

- Construct rock check dams from appropriately sized rock. The rock used must be large enough to stay in place given the expected design flow through the channel. The rock must be placed by hand or by mechanical means (do not dump the rock to form the dam) to achieve complete coverage of the ditch or swale and to ensure that the center of the dam is lower than the edges.
- Check dams may also be constructed of either rock or pea-gravel filled bags. Numerous new products are also available for this purpose. They tend to be re-usable, quick and easy to install, effective, and cost efficient.
- Place check dams perpendicular to the flow of water.
- The check dam should form a triangle when viewed from the side. This prevents undercutting as water flows over the face of the check dam rather than falling directly onto the ditch bottom.
- Before installing check dams, impound and bypass upstream water flow away from the work area. Options for bypassing include pumps, siphons, or temporary channels.
- Check dams combined with sumps work more effectively at slowing flow and retaining sediment than a check dam alone. A deep sump should be provided immediately upstream of the check dam.
- In some cases, if carefully located and designed, check dams can remain as permanent installations with very minor regrading. They may be left as either spillways, in which case accumulated sediment would be graded and seeded, or as check dams to prevent further sediment from leaving the site.
- The maximum spacing between check dams shall be such that the downstream toe of the

upstream dam is at the same elevation as the top of the downstream dam.

- Keep the maximum height at 2 feet at the center of the check dam.
- Keep the center of the check dam at least 12 inches lower than the outer edges at natural ground elevation.
- Keep the side slopes of the check dam at 2H:1V or flatter.
- Key the stone into the ditch banks and extend it beyond the abutments a minimum of 18 inches to avoid washouts from overflow around the dam.
- Use filter fabric foundation under a rock or sand bag check dam. If a blanket ditch liner is used, filter fabric is not necessary. A piece of organic or synthetic blanket cut to fit will also work for this purpose.
- In the case of grass-lined ditches and swales, all check dams and accumulated sediment shall be removed when the grass has matured sufficiently to protect the ditch or swale - unless the slope of the swale is greater than 4 percent. The area beneath the check dams shall be seeded and mulched immediately after dam removal.
- Ensure that channel appurtenances, such as culvert entrances below check dams, are not subject to damage or blockage from displaced stones.
- See Figure II-3.16: Rock Check Dam.

Maintenance Standards

Check dams shall be monitored for performance and sediment accumulation during and after each rainfall that produces runoff. Sediment shall be removed when it reaches one half the sump depth.

- Anticipate submergence and deposition above the check dam and erosion from high flows around the edges of the dam.
- If significant erosion occurs between dams, install a protective riprap liner in that portion of the channel. See BMP C202: Riprap Channel Lining.


Approved as Functionally Equivalent

Ecology has approved products as able to meet the requirements of this BMP. The products did not pass through the Technology Assessment Protocol – Ecology (TAPE) process. Local jurisdictions may choose not to accept these products, or may require additional testing prior to consideration for local use. Products that Ecology has approved as functionally equivalent are available for review on Ecology's website at:

https://ecology.wa.gov/Regulations-Permits/Guidance-technical-assistance/Stormwater-permittee-guidance-resources/Emerging-stormwater-treatment-technologies


Figure II-3.16: Rock Check Dam

View Looking Upstream

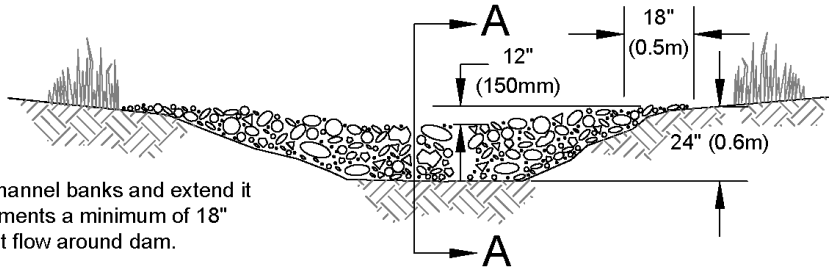


Note:
Key stone into channel banks and extend it beyond the abutments a minimum of 18" (0.5m) to prevent flow around dam.

Section A-A

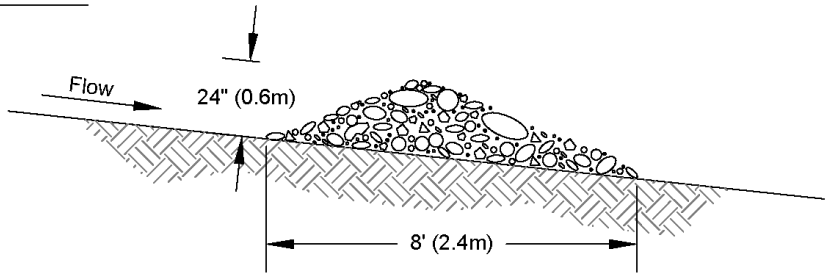

Spacing Between Check Dams

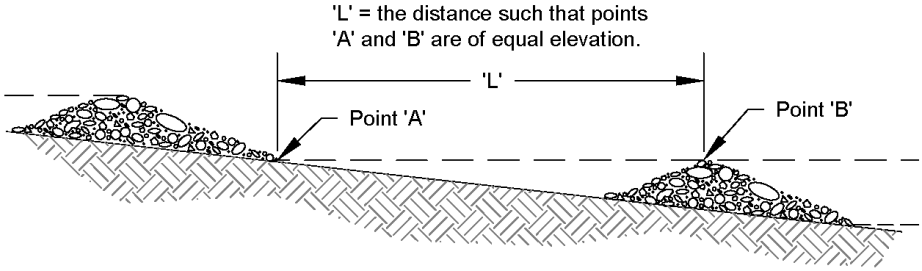

NOT TO SCALE

DEPARTMENT OF ECOLOGY
State of Washington

Rock Check Dam

Revised June 2016

Please see *http://www.ecy.wa.gov/copyright.html* for copyright notice including permissions, limitation of liability, and disclaimer.

BMP C209: Outlet Protection

Purpose

Outlet protection prevents scour at conveyance outlets and minimizes the potential for downstream erosion by reducing the velocity of concentrated stormwater flows.

Conditions of Use

Use outlet protection at the outlets of all ponds, pipes, ditches, or other conveyances that discharge to a natural or manmade drainage feature such as a stream, wetland, lake, or ditch.

Design and Installation Specifications

- The receiving channel at the outlet of a pipe shall be protected from erosion by lining a minimum of 6 feet downstream and extending up the channel sides a minimum of 1–foot above the maximum tailwater elevation, or 1-foot above the crown, whichever is higher. For pipes larger than 18 inches in diameter, the outlet protection lining of the channel shall be four times the diameter of the outlet pipe.
- Standard wingwalls, tapered outlets, and paved channels should also be considered when appropriate for permanent culvert outlet protection (WSDOT, 2015).
- BMP C122: Nets and Blankets or BMP C202: Riprap Channel Lining provide suitable options for lining materials.
- With low flows, BMP C201: Grass-Lined Channels can be an effective alternative for lining material.
- The following guidelines shall be used for outlet protection with riprap:
    - If the discharge velocity at the outlet is less than 5 fps, use 2-inch to 8-inch riprap. Minimum thickness is 1-foot.
    - For 5 to 10 fps discharge velocity at the outlet, use 24-inch to 48-inch riprap. Minimum

thickness is 2 feet.

- For outlets at the base of steep slope pipes (pipe slope greater than 10 percent), use an engineered energy dissipator.
- Filter fabric or erosion control blankets should always be used under riprap to prevent scour and channel erosion. See BMP C122: Nets and Blankets.

- Bank stabilization, bioengineering, and habitat features may be required for disturbed areas. This work may require a Hydraulic Project Approval (HPA) from the Washington State Department of Fish and Wildlife. See I-2.11 Hydraulic Project Approvals.

Maintenance Standards

- Inspect and repair as needed.
- Add rock as needed to maintain the intended function.
- Clean energy dissipator if sediment builds up.

BMP C220: Inlet Protection

Purpose

Inlet protection prevents coarse sediment from entering drainage systems prior to permanent stabilization of the disturbed area.

Conditions of Use

Use inlet protection at inlets that are operational before permanent stabilization of the disturbed areas that contribute runoff to the inlet. Provide protection for all storm drain inlets downslope and within 500 feet of a disturbed or construction area, unless those inlets are preceded by a sediment trapping BMP.

Also consider inlet protection for lawn and yard drains on new home construction. These small and numerous drains coupled with lack of gutters can add significant amounts of sediment into the roof drain system. If possible, delay installing lawn and yard drains until just before landscaping, or cap these drains to prevent sediment from entering the system until completion of landscaping. Provide 18-inches of sod around each finished lawn and yard drain.

Table II-3.10: Storm Drain Inlet Protection lists several options for inlet protection. All of the methods for inlet protection tend to plug and require a high frequency of maintenance. Limit contributing drainage areas for an individual inlet to one acre or less. If possible, provide emergency overflows with additional end-of-pipe treatment where stormwater ponding would cause a hazard.

Table II-3.10: Storm Drain Inlet Protection

Type of Inlet Protection	Emergency Overflow	Applicable for Paved/ Earthen Surfaces	Conditions of Use
Drop Inlet Protection			
Excavated drop inlet protection	Yes, temporary flooding may occur	Earthen	Applicable for heavy flows. Easy to maintain. Large area requirement: 30'x30'/acre
Block and gravel drop inlet protection	Yes	Paved or Earthen	Applicable for heavy concentrated flows. Will not pond.
Gravel and wire drop inlet protection	No	Paved or Earthen	Applicable for heavy concentrated flows. Will pond. Can withstand traffic.
Catch basin filters	Yes	Paved or Earthen	Frequent maintenance required.
Curb Inlet Protection			
Curb inlet protection with wooden weir	Small capacity overflow	Paved	Used for sturdy, more compact installation.
Block and gravel curb inlet protection	Yes	Paved	Sturdy, but limited filtration.
Culvert Inlet Protection			
Culvert inlet sediment trap	N/A	N/A	18 month expected life.

Design and Installation Specifications

Excavated Drop Inlet Protection

Excavated drop inlet protection consists of an excavated impoundment around the storm drain inlet. Sediment settles out of the stormwater prior to entering the storm drain. Design and installation specifications for excavated drop inlet protection include:

- Provide a depth of 1-2 ft as measured from the crest of the inlet structure.
- Slope sides of excavation should be no steeper than 2H:1V.
- Minimum volume of excavation is 35 cubic yards.
- Shape the excavation to fit the site, with the longest dimension oriented toward the longest inflow area.
- Install provisions for draining to prevent standing water.
- Clear the area of all debris.


- Grade the approach to the inlet uniformly.
- Drill weep holes into the side of the inlet.
- Protect weep holes with screen wire and washed aggregate.
- Seal weep holes when removing structure and stabilizing area.
- Build a temporary dike, if necessary, to the down slope side of the structure to prevent bypass flow.

Block and Gravel Filter


A block and gravel filter is a barrier formed around the inlet with standard concrete blocks and gravel. See Figure II-3.17: Block and Gravel Filter. Design and installation specifications for block gravel filters include:

- Provide a height of 1 to 2 feet above the inlet.
- Recess the first row of blocks 2-inches into the ground for stability.
- Support subsequent courses by placing a pressure treated wood 2x4 through the block opening.
- Do not use mortar.
- Lay some blocks in the bottom row on their side to allow for dewatering the pool.
- Place hardware cloth or comparable wire mesh with ½-inch openings over all block openings.
- Place gravel to just below the top of blocks on slopes of 2H:1V or flatter.
- An alternative design is a gravel berm surrounding the inlet, as follows:
    - Provide a slope of 3H:1V on the upstream side of the berm.
    - Provide a slope of 2H:1V on the downstream side of the berm.
    - Provide a 1-foot wide level stone area between the gravel berm and the inlet.
    - Use stones 3 inches in diameter or larger on the upstream slope of the berm.
    - Use gravel ½- to ¾-inch at a minimum thickness of 1-foot on the downstream slope of the berm.

Figure II-3.17: Block and Gravel Filter

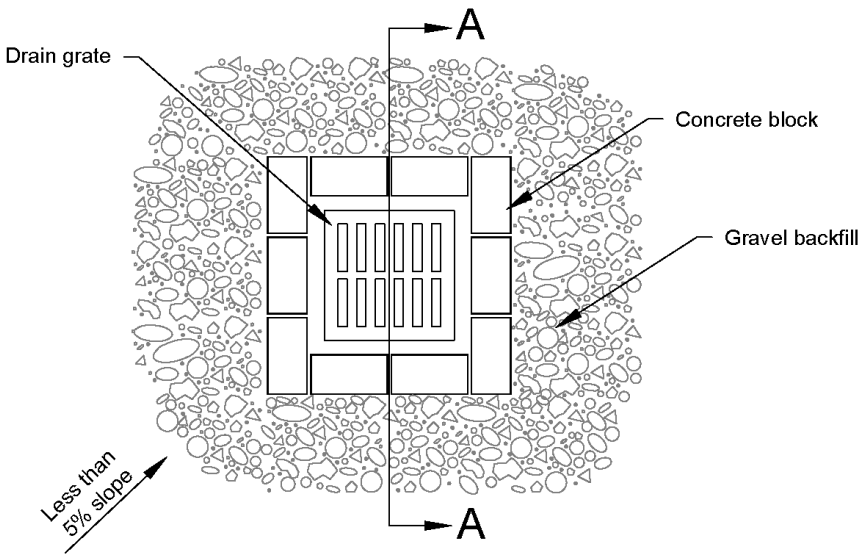

Plan View

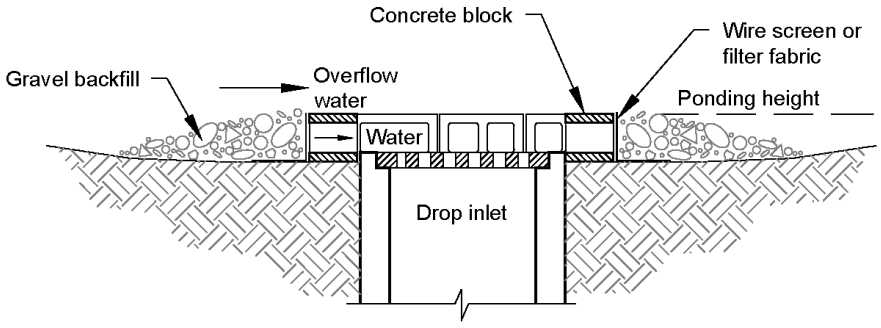

Section A-A

Notes:

1. Drop inlet sediment barriers are to be used for small, nearly level drainage areas. (less than 5%)
2. Excavate a basin of sufficient size adjacent to the drop inlet.
3. The top of the structure (ponding height) must be well below the ground elevation downslope to prevent runoff from bypassing the inlet. A temporary dike may be necessary on the downslope side of the structure.

NOT TO SCALE

DEPARTMENT OF ECOLOGY
State of Washington

Block and Gravel Filter

Revised June 2016

Please see *http://www.ecy.wa.gov/copyright.html* for copyright notice including permissions, limitation of liability, and disclaimer.

Gravel and Wire Mesh Filter

Gravel and wire mesh filters are gravel barriers placed over the top of the inlet. This method does not provide an overflow. Design and installation specifications for gravel and wire mesh filters include:

- Use a hardware cloth or comparable wire mesh with ½-inch openings.
    - Place wire mesh over the drop inlet so that the wire extends a minimum of 1-foot beyond each side of the inlet structure.
    - Overlap the strips if more than one strip of mesh is necessary.
- Place coarse aggregate over the wire mesh.
    - Provide at least a 12-inch depth of aggregate over the entire inlet opening and extend at least 18-inches on all sides.

Catch Basin Filters

Catch basin filters are designed by manufacturers for construction sites. The limited sediment storage capacity increases the amount of inspection and maintenance required, which may be daily for heavy sediment loads. To reduce maintenance requirements, combine a catch basin filter with another type of inlet protection. This type of inlet protection provides flow bypass without overflow and therefore may be a better method for inlets located along active rights-of-way. Design and installation specifications for catch basin filters include:

- Provides 5 cubic feet of storage.
- Requires dewatering provisions.
- Provides a high-flow bypass that will not clog under normal use at a construction site.
- Insert the catch basin filter in the catch basin just below the grating.

Curb Inlet Protection with Wooden Weir

Curb inlet protection with wooden weir is an option that consists of a barrier formed around a curb inlet with a wooden frame and gravel. Design and installation specifications for curb inlet protection with wooden weirs include:


- Use wire mesh with ½-inch openings.
- Use extra strength filter cloth.
- Construct a frame.
- Attach the wire and filter fabric to the frame.
- Pile coarse washed aggregate against the wire and fabric.
- Place weight on the frame anchors.

Block and Gravel Curb Inlet Protection

Block and gravel curb inlet protection is a barrier formed around a curb inlet with concrete blocks and gravel. See Figure II-3.18: Block and Gravel Curb Inlet Protection. Design and installation specifications for block and gravel curb inlet protection include:

- Use wire mesh with ½-inch openings.
- Place two concrete blocks on their sides abutting the curb at either side of the inlet opening. These are spacer blocks.
- Place a 2x4 stud through the outer holes of each spacer block to align the front blocks.
- Place blocks on their sides across the front of the inlet and abutting the spacer blocks.
- Place wire mesh over the outside vertical face.
- Pile coarse aggregate against the wire to the top of the barrier.

Figure II-3.18: Block and Gravel Curb Inlet Protection

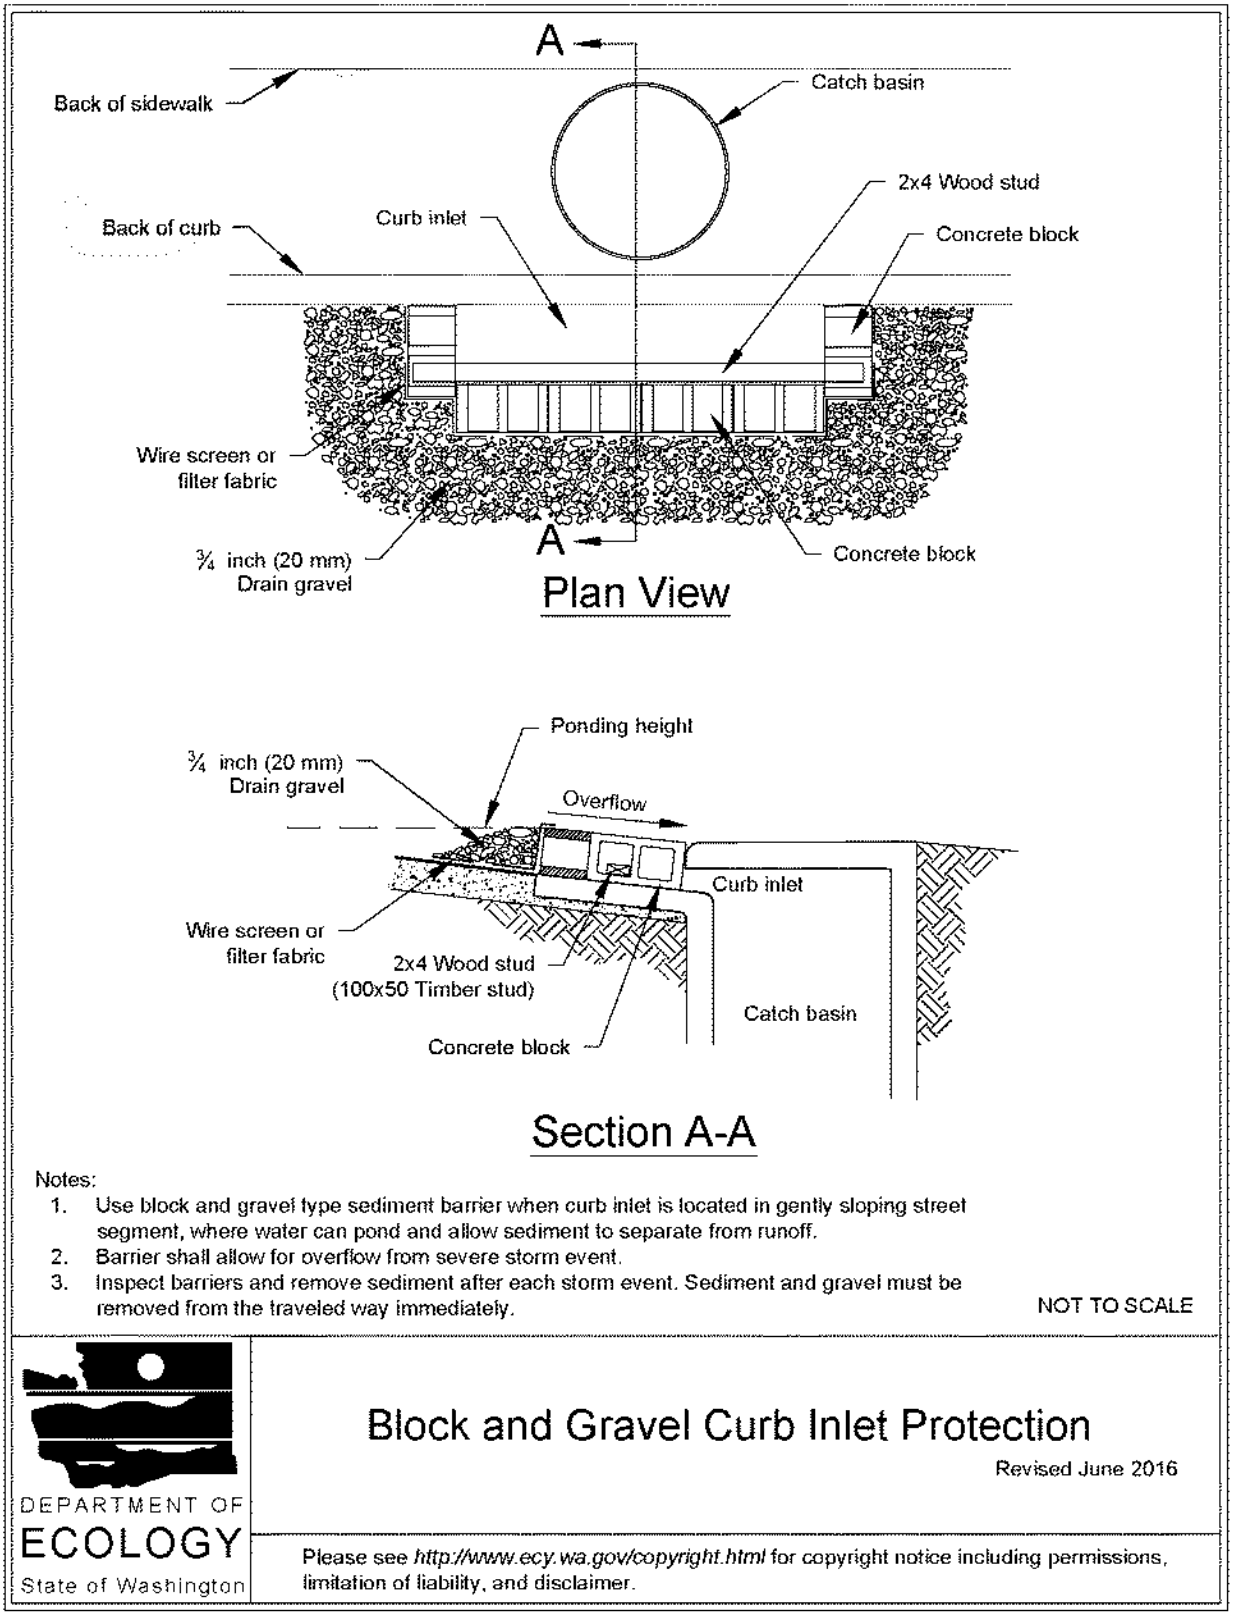


Curb and Gutter Sediment Barrier

Curb and gutter sediment barrier is a sandbag or rock berm (riprap and aggregate) 3 feet high and 3 feet wide in a horseshoe shape. See Figure II-3.19: Curb and Gutter Barrier. Design and installation specifications for curb and gutter sediment barrier include:

- Construct a horseshoe shaped berm, faced with coarse aggregate if using riprap, 3 feet high and 3 feet wide, at least 2 feet from the inlet.
- Construct a horseshoe shaped sedimentation trap on the upstream side of the berm. Size the trap to sediment trap standards for protecting a culvert inlet.

Figure II-3.19: Curb and Gutter Barrier

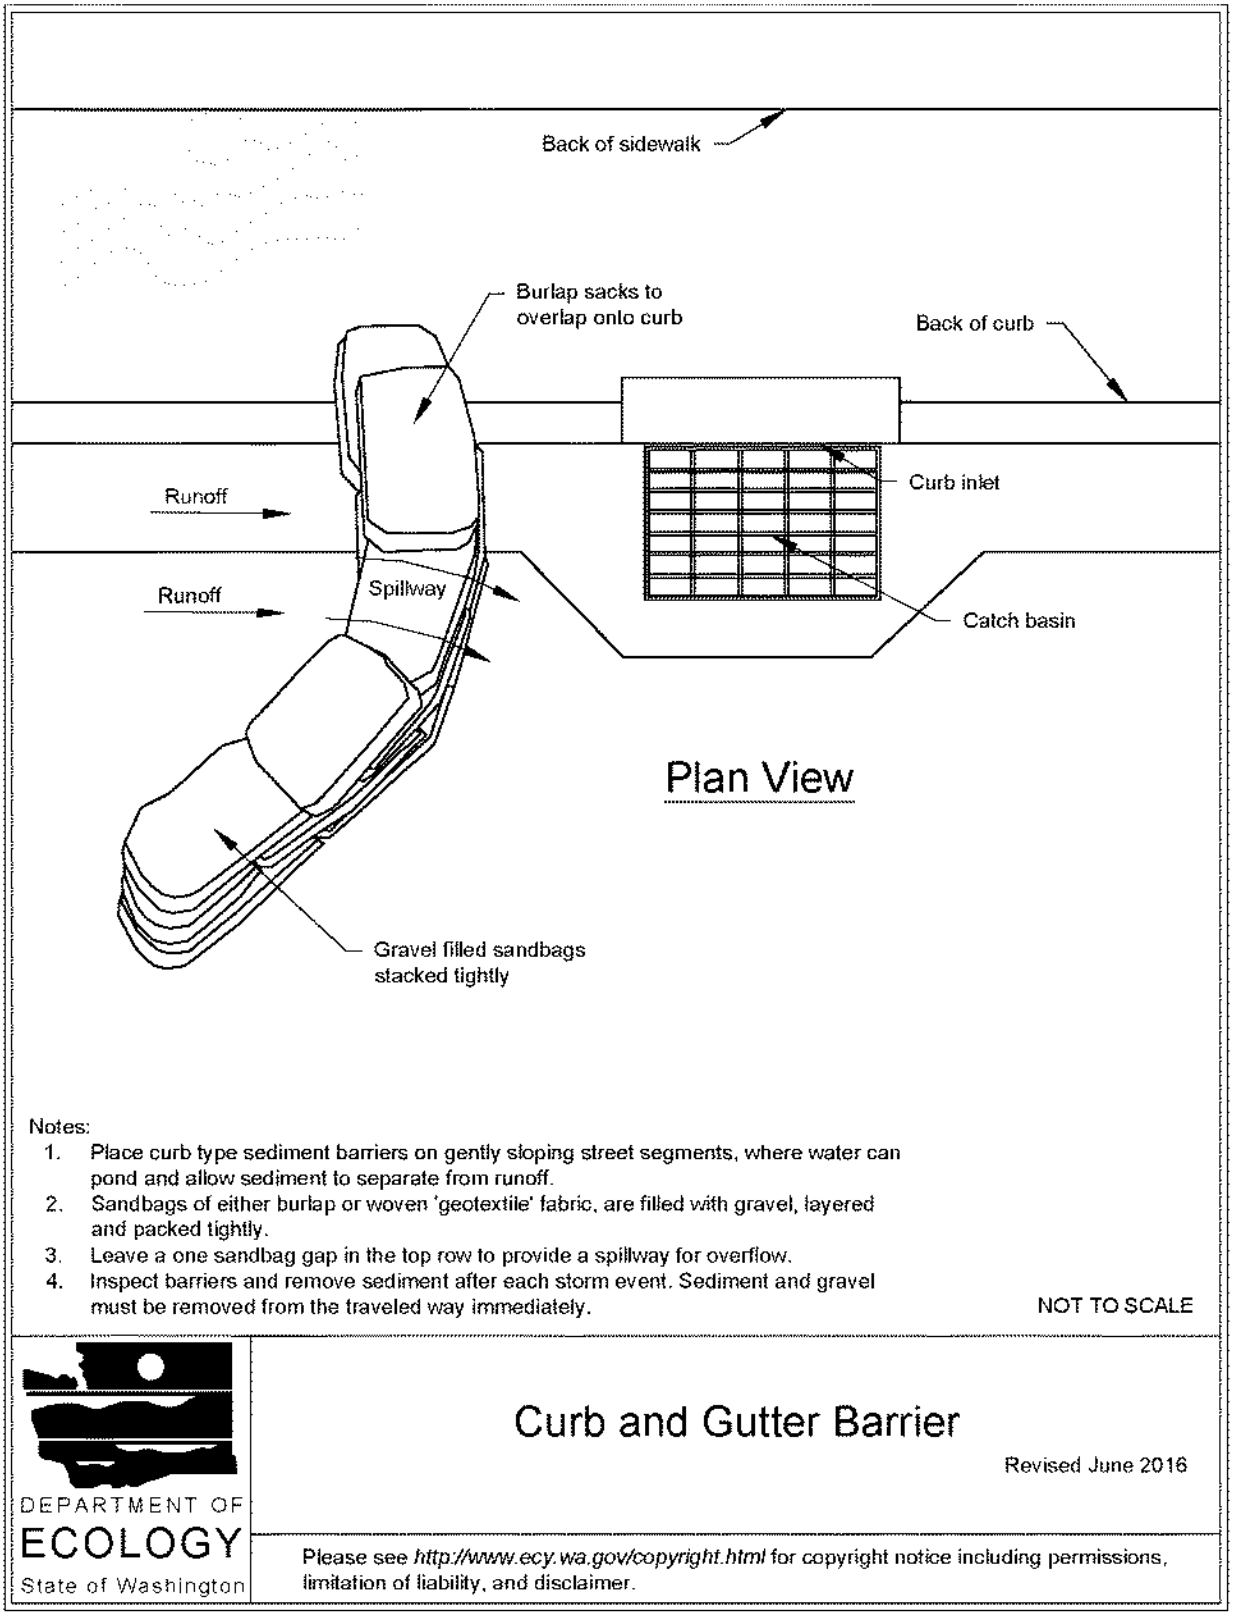

Maintenance Standards

- Inspect all forms of inlet protection frequently, especially after storm events. Clean and replace clogged catch basin filters. For rock and gravel filters, pull away the rocks from the inlet and clean or replace. An alternative approach would be to use the clogged rock as fill and put fresh rock around the inlet.
- Do not wash sediment into storm drains while cleaning. Spread all excavated material evenly over the surrounding land area or stockpile and stabilize as appropriate.

Approved as Functionally Equivalent

Ecology has approved products as able to meet the requirements of this BMP. The products did not pass through the Technology Assessment Protocol – Ecology (TAPE) process. Local jurisdictions may choose not to accept these products, or may require additional testing prior to consideration for local use. Products that Ecology has approved as functionally equivalent are available for review on Ecology's website at:

https://ecology.wa.gov/Regulations-Permits/Guidance-technical-assistance/Stormwater-permittee-guidance-resources/Emerging-stormwater-treatment-technologies

BMP C233: Silt Fence

Purpose


Silt fence reduces the transport of coarse sediment from a construction site by providing a temporary physical barrier to sediment and reducing the runoff velocities of overland flow.

Conditions of Use

Silt fence may be used downslope of all disturbed areas.

- Silt fence shall prevent sediment carried by runoff from going beneath, through, or over the top of the silt fence, but shall allow the water to pass through the fence.
- Silt fence is not intended to treat concentrated flows, nor is it intended to treat substantial amounts of overland flow. Convey any concentrated flows through the drainage system to a sediment trapping BMP.
- Do not construct silt fences in streams or use in V-shaped ditches. Silt fences do not provide an adequate method of silt control for anything deeper than sheet or overland flow.

Figure II-3.22: Silt Fence

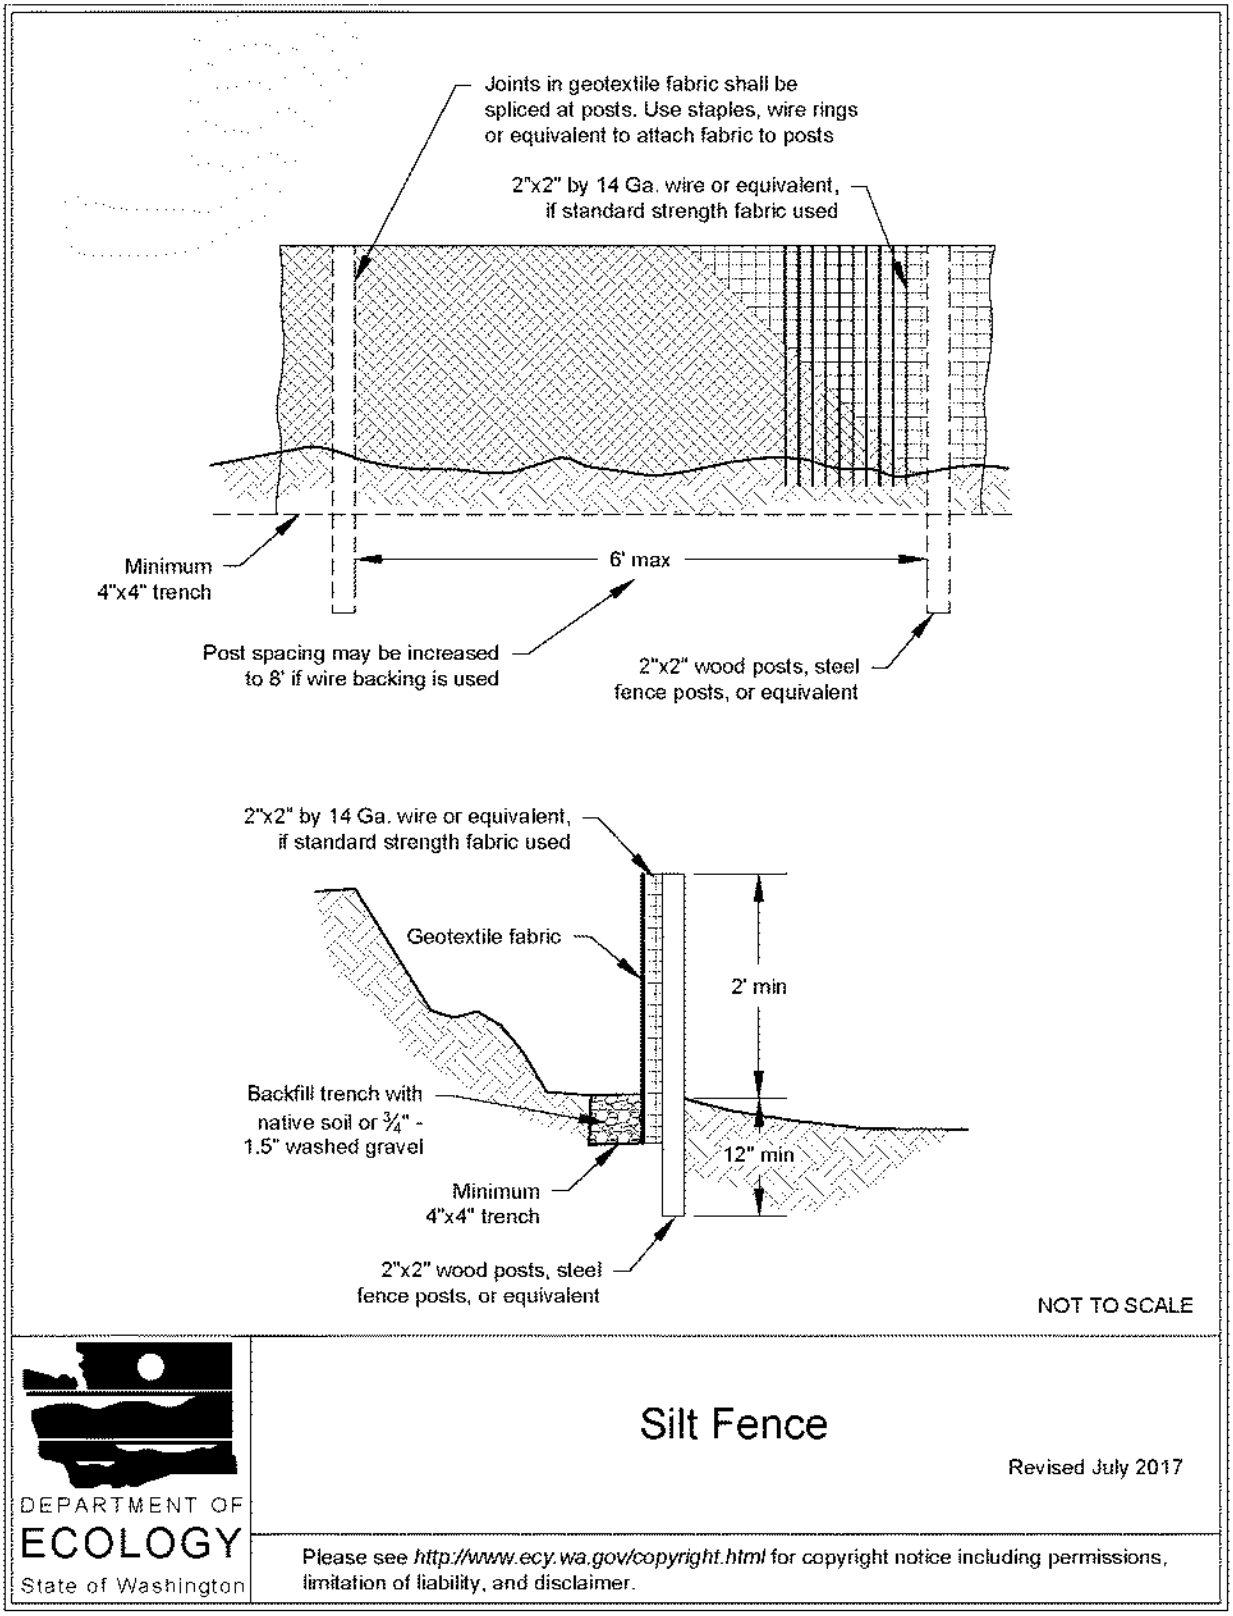

Design and Installation Specifications

- Use in combination with other construction stormwater BMPs.
- Maximum slope steepness (perpendicular to the silt fence line) 1H:1V.
- Maximum sheet or overland flow path length to the silt fence of 100 feet.
- Do not allow flows greater than 0.5 cfs.
- Use geotextile fabric that meets the following standards. All geotextile properties listed below are minimum average roll values (i.e., the test result for any sampled roll in a lot shall meet or exceed the values shown in Table II-3.11: Geotextile Fabric Standards for Silt Fence):

Table II-3.11: Geotextile Fabric Standards for Silt Fence

Geotextile Property	Minimum Average Roll Value
Polymeric Mesh AOS (ASTM D4751)	0.60 mm maximum for slit film woven (#30 sieve). 0.30 mm maximum for all other geotextile types (#50 sieve). 0.15 mm minimum for all fabric types (#100 sieve).
Water Permittivity (ASTM D4491)	0.02 sec^{-1} minimum
Grab Tensile Strength (ASTM D4632)	180 lbs. Minimum for extra strength fabric. 100 lbs minimum for standard strength fabric.
Grab Tensile Strength (ASTM D4632)	30% maximum
Ultraviolet Resistance (ASTM D4355)	70% minimum

- Support standard strength geotextiles with wire mesh, chicken wire, 2-inch x 2-inch wire, safety fence, or jute mesh to increase the strength of the geotextile. Silt fence materials are available that have synthetic mesh backing attached.
- Silt fence material shall contain ultraviolet ray inhibitors and stabilizers to provide a minimum of six months of expected usable construction life at a temperature range of 0°F to 120°F.
- One-hundred percent biodegradable silt fence is available that is strong, long lasting, and can be left in place after the project is completed, if permitted by the local jurisdiction.
- Refer to Figure II-3.22: Silt Fence for standard silt fence details. Include the following Standard Notes for silt fence on construction plans and specifications:

    1. The Contractor shall install and maintain temporary silt fences at the locations shown in the Plans.
    2. Construct silt fences in areas of clearing, grading, or drainage prior to starting those activities.


3. The silt fence shall have a 2-feet min. and a 2½-feet max. height above the original ground surface.
4. The geotextile fabric shall be sewn together at the point of manufacture to form fabric lengths as required. Locate all sewn seams at support posts. Alternatively, two sections of silt fence can be overlapped, provided that the overlap is long enough and that the adjacent silt fence sections are close enough together to prevent silt laden water from escaping through the fence at the overlap.
5. Attach the geotextile fabric on the up-slope side of the posts and secure with staples, wire, or in accordance with the manufacturer's recommendations. Attach the geotextile fabric to the posts in a manner that reduces the potential for tearing.
6. Support the geotextile fabric with wire or plastic mesh, dependent on the properties of the geotextile selected for use. If wire or plastic mesh is used, fasten the mesh securely to the up-slope side of the posts with the geotextile fabric up-slope of the mesh.
7. Mesh support, if used, shall consist of steel wire with a maximum mesh spacing of 2-inches, or a prefabricated polymeric mesh. The strength of the wire or polymeric mesh shall be equivalent to or greater than 180 lbs. grab tensile strength. The polymeric mesh must be as resistant to the same level of ultraviolet radiation as the geotextile fabric it supports.
8. Bury the bottom of the geotextile fabric 4-inches min. below the ground surface. Backfill and tamp soil in place over the buried portion of the geotextile fabric, so that no flow can pass beneath the silt fence and scouring cannot occur. When wire or polymeric back-up support mesh is used, the wire or polymeric mesh shall extend into the ground 3-inches min.
9. Drive or place the silt fence posts into the ground 18-inches min. A 12–inch min. depth is allowed if topsoil or other soft subgrade soil is not present and 18-inches cannot be reached. Increase fence post min. depths by 6 inches if the fence is located on slopes of 3H:1V or steeper and the slope is perpendicular to the fence. If required post depths cannot be obtained, the posts shall be adequately secured by bracing or guying to prevent overturning of the fence due to sediment loading.
10. Use wood, steel or equivalent posts. The spacing of the support posts shall be a maximum of 6-feet. Posts shall consist of either:
    - Wood with minimum dimensions of 2 inches by 2 inches by 3 feet. Wood shall be free of defects such as knots, splits, or gouges.
    - No. 6 steel rebar or larger.
    - ASTM A 120 steel pipe with a minimum diameter of 1-inch.
    - U, T, L, or C shape steel posts with a minimum weight of 1.35 lbs./ft.
    - Other steel posts having equivalent strength and bending resistance to the post sizes listed above.
11. Locate silt fences on contour as much as possible, except at the ends of the fence,

where the fence shall be turned uphill such that the silt fence captures the runoff water and prevents water from flowing around the end of the fence.

12. If the fence must cross contours, with the exception of the ends of the fence, place check dams perpendicular to the back of the fence to minimize concentrated flow and erosion. The slope of the fence line where contours must be crossed shall not be steeper than 3H:1V.
    - Check dams shall be approximately 1-foot deep at the back of the fence. Check dams shall be continued perpendicular to the fence at the same elevation until the top of the check dam intercepts the ground surface behind the fence.
    - Check dams shall consist of crushed surfacing base course, gravel backfill for walls, or shoulder ballast. Check dams shall be located every 10 feet along the fence where the fence must cross contours.

- Refer to Figure II-3.23: Silt Fence Installation by Slicing Method for slicing method details. The following are specifications for silt fence installation using the slicing method:
    1. The base of both end posts must be at least 2- to 4-inches above the top of the geotextile fabric on the middle posts for ditch checks to drain properly. Use a hand level or string level, if necessary, to mark base points before installation.
    2. Install posts 3- to 4-feet apart in critical retention areas and 6- to 7-feet apart in standard applications.
    3. Install posts 24-inches deep on the downstream side of the silt fence, and as close as possible to the geotextile fabric, enabling posts to support the geotextile fabric from upstream water pressure.
    4. Install posts with the nipples facing away from the geotextile fabric.
    5. Attach the geotextile fabric to each post with three ties, all spaced within the top 8-inches of the fabric. Attach each tie diagonally 45 degrees through the fabric, with each puncture at least 1-inch vertically apart. Each tie should be positioned to hang on a post nipple when tightening to prevent sagging.
    6. Wrap approximately 6-inches of the geotextile fabric around the end posts and secure with 3 ties.
    7. No more than 24-inches of a 36-inch geotextile fabric is allowed above ground level.
    8. Compact the soil immediately next to the geotextile fabric with the front wheel of the tractor, skid steer, or roller exerting at least 60 pounds per square inch. Compact the upstream side first and then each side twice for a total of four trips. Check and correct the silt fence installation for any deviation before compaction. Use a flat-bladed shovel to tuck the fabric deeper into the ground if necessary.

Figure II-3.23: Silt Fence Installation by Slicing Method

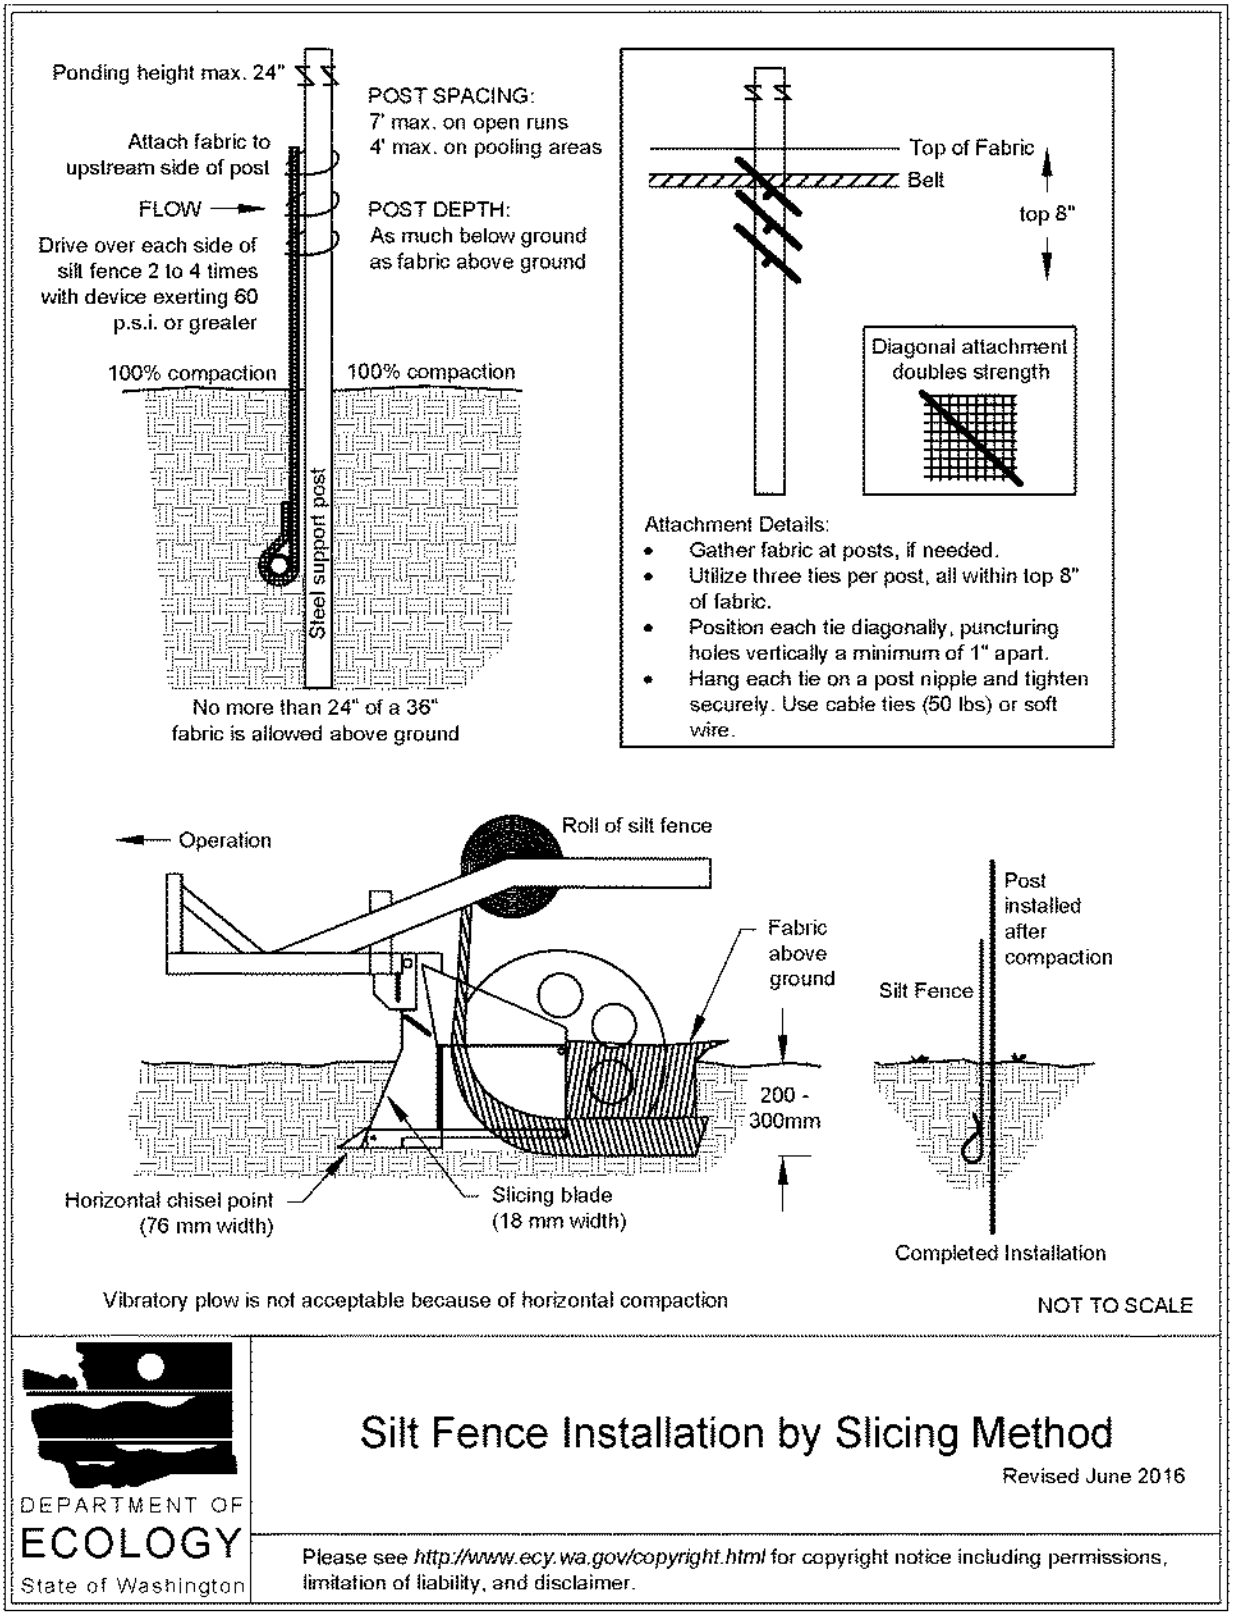

Maintenance Standards

- Repair any damage immediately.
- Intercept and convey all evident concentrated flows uphill of the silt fence to a sediment trapping BMP.
- Check the uphill side of the silt fence for signs of the fence clogging and acting as a barrier to flow and then causing channelization of flows parallel to the fence. If this occurs, replace the fence and remove the trapped sediment.
- Remove sediment deposits when the deposit reaches approximately one-third the height of the silt fence, or install a second silt fence.
- Replace geotextile fabric that has deteriorated due to ultraviolet breakdown.

BMP C235: Wattles

Purpose

Wattles are temporary erosion and sediment control barriers consisting of straw, compost, or other material that is wrapped in netting made of natural plant fiber or similar encasing material. They reduce the velocity and can spread the flow of rill and sheet runoff, and can capture and retain sediment.

Conditions of Use


- Wattles shall consist of cylinders of plant material such as weed-free straw, coir, wood chips, excelsior, or wood fiber or shavings encased within netting made of natural plant fibers unaltered by synthetic materials.
- Use wattles:
    - In disturbed areas that require immediate erosion protection.
    - On exposed soils during the period of short construction delays, or over winter months.
    - On slopes requiring stabilization until permanent vegetation can be established.
- The material used dictates the effectiveness period of the wattle. Generally, wattles are effective for one to two seasons.

- Prevent rilling beneath wattles by entrenching and overlapping wattles to prevent water from passing between them.

Design Criteria

- See Figure II-3.24: Wattles for typical construction details.
- Wattles are typically 8 to 10 inches in diameter and 25 to 30 feet in length.
- Install wattles perpendicular to the flow direction and parallel to the slope contour.
- Place wattles in shallow trenches, staked along the contour of disturbed or newly constructed slopes. Dig narrow trenches across the slope (on contour) to a depth of 3- to 5-inches on clay soils and soils with gradual slopes. On loose soils, steep slopes, and areas with high rainfall, the trenches should be dug to a depth of 5- to 7- inches, or 1/2 to 2/3 of the thickness of the wattle.
- Start building trenches and installing wattles from the base of the slope and work up. Spread excavated material evenly along the uphill slope and compact it using hand tamping or other methods.
- Construct trenches at intervals of 10- to 25-feet depending on the steepness of the slope, soil type, and rainfall. The steeper the slope the closer together the trenches.
- Install the wattles snugly into the trenches and overlap the ends of adjacent wattles 12 inches behind one another.
- Install stakes at each end of the wattle, and at 4-foot centers along entire length of wattle.
- If required, install pilot holes for the stakes using a straight bar to drive holes through the wattle and into the soil.
- Wooden stakes should be approximately 0.75 x 0.75 x 24 inches min. Willow cuttings or 3/8-inch rebar can also be used for stakes.
- Stakes should be driven through the middle of the wattle, leaving 2 to 3 inches of the stake protruding above the wattle.

Figure II-3.24: Wattles

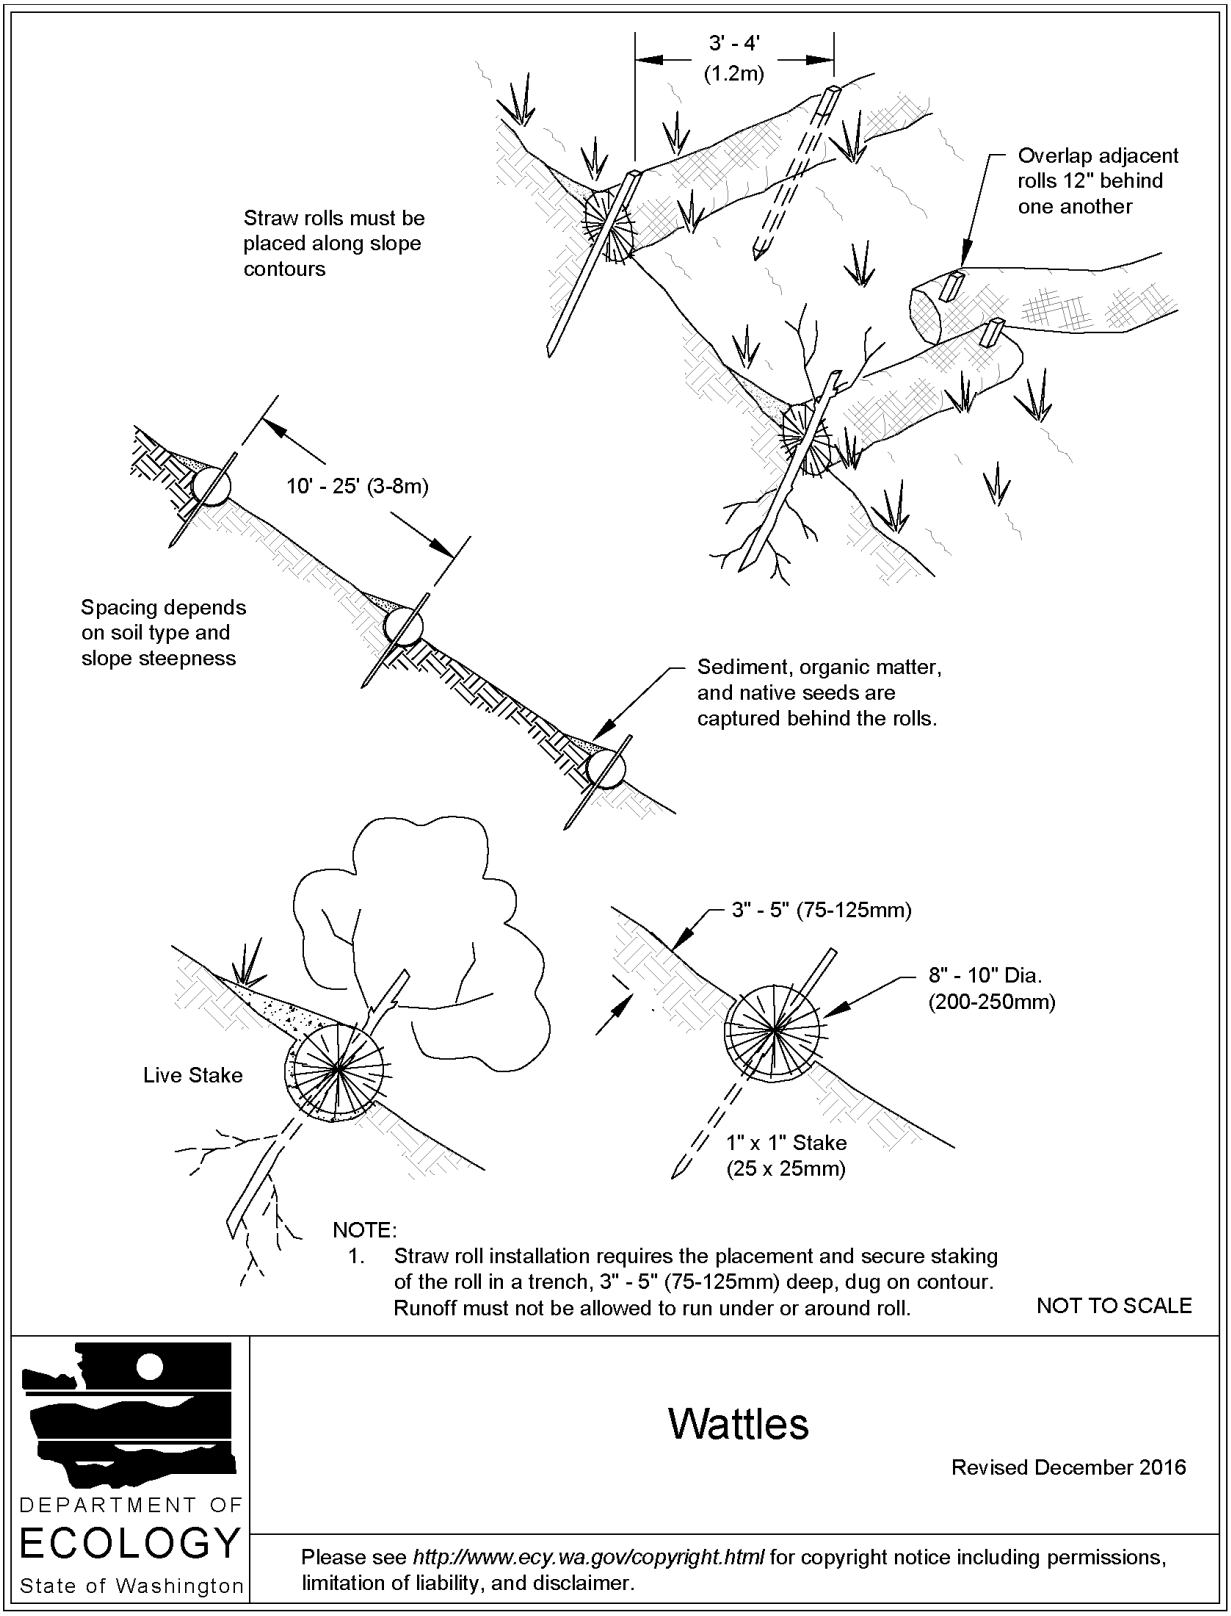

Please see *http://www.ecy.wa.gov/copyright.html* for copyright notice including permissions, limitation of liability, and disclaimer.

Maintenance Standards

- Wattles may require maintenance to ensure they are in contact with soil and thoroughly entrenched, especially after significant rainfall on steep sandy soils.
- Inspect the slope after significant storms and repair any areas where wattles are not tightly abutted or water has scoured beneath the wattles.

Approved as Functionally Equivalent

Ecology has approved products as able to meet the requirements of this BMP. The products did not pass through the Technology Assessment Protocol – Ecology (TAPE) process. Local jurisdictions may choose not to accept these products, or may require additional testing prior to consideration for local use. Products that Ecology has approved as functionally equivalent are available for review on Ecology's website at:

https://ecology.wa.gov/Regulations-Permits/Guidance-technical-assistance/Stormwater-permittee-guidance-resources/Emerging-stormwater-treatment-technologies

BMP C241: Sediment Pond (Temporary)

Purpose

Sediment ponds are temporary ponds used during construction to remove sediment from runoff originating from disturbed areas of the project site. Sediment ponds are typically designed to remove sediment no smaller than medium silt (0.02 mm). Consequently, they usually reduce turbidity only slightly.

Conditions of Use

- Use a sediment pond where the contributing drainage area to the pond is 3 acres or more. Ponds must be used in conjunction with other Construction Stormwater BMPs to reduce the amount of sediment flowing into the pond.
- Do not install sediment ponds on sites where failure of the BMP would result in loss of life, damage to homes or buildings, or interruption of use or service of public roads or utilities. Also, sediment ponds are attractive to children and can be dangerous. Compliance with local ordinances regarding health and safety must be addressed. If fencing of the pond is required, show the type of fence and its location on the drawings in the Construction SWPPP.
- Sediment ponds that can impound 10 acre-ft (435,600 cu-ft, or 3.26 million gallons) or more, or have an embankment of more than 6 feet, are subject to the Washington Dam Safety Regulations (Chapter 173-175 WAC). See BMP D.1: Detention Ponds for more information regarding dam safety considerations for detention ponds.
- Projects that are constructing permanent Flow Control BMPs or Runoff Treatment BMPs that use ponding for treatment may use the rough-graded or final-graded permanent BMP footprint for the temporary sediment pond. When permanent BMP footprints are used as temporary sediment ponds, the surface area requirement of the temporary sediment pond must be met. If the surface area requirement of the sediment pond is larger than the surface area of the permanent BMP, then the sediment pond shall be enlarged beyond the permanent BMP footprint to comply with the surface area requirement.

  The permanent control structure must be temporarily replaced with a control structure that only allows water to leave the temporary sediment pond from the surface or by pumping. Alternatively, the permanent control structure may used if it is temporarily modified by plugging any outlet holes below the riser. The permanent control structure must be installed as part of the permanent BMP after the site is fully stabilized.

Design and Installation Specifications

General

- See Figure II-3.28: Sediment Pond Plan View, Figure II-3.29: Sediment Pond Cross Section, and Figure II-3.30: Sediment Pond Riser Detail for details.
- Use of permanent infiltration BMP footprints for temporary sediment ponds during

construction tends to clog the soils and reduce their capacity to infiltrate. If permanent infiltration BMP footprints are used, the sides and bottom of the temporary sediment pond must only be rough excavated to a minimum of 2 feet above final grade of the permanent infiltration BMP. Final grading of the permanent infiltration BMP shall occur only when all contributing drainage areas are fully stabilized. Any proposed permanent pretreatment BMP prior to the infiltration BMP should be fully constructed and used with the temporary sediment pond to help prevent clogging of the soils. See Element 13: Protect Low Impact Development BMPs for more information about protecting permanent infiltration BMPs.

- The pond shall be divided into two roughly equal volume cells by a permeable divider that will reduce turbulence while allowing movement of water between the cells. The divider shall be at least one-half the height of the riser, and at least one foot below the top of the riser. Wire-backed, 2- to 3-foot high, high strength geotextile fabric supported by treated 4"x4"s can be used as a divider. Alternatively, staked straw bales wrapped with geotextile fabric may be used. If the pond is more than 6 feet deep, a different divider design must be proposed. A riprap embankment is one acceptable method of separation for deeper ponds. Other designs that satisfy the intent of this provision are allowed as long as the divider is permeable, structurally sound, and designed to prevent erosion under and around the divider.
- The most common structural failure of sediment ponds is caused by piping. Piping refers to two phenomena: (1) water seeping through fine-grained soil, eroding the soil grain by grain and forming pipes or tunnels; and, (2) water under pressure flowing upward through a granular soil with a head of sufficient magnitude to cause soil grains to lose contact and capability for support.

  The most critical construction practices to prevent piping are:

  - Tight connections between the riser and outlet pipe, and other pipe connections.
  - Adequate anchoring of the riser.
  - Proper soil compaction of the embankment and riser footing.
  - Proper construction of anti-seep devices.

Sediment Pond Geometry

To determine the sediment pond geometry, first calculate the design surface area (SA) of the pond, measured at the top of the riser pipe. Use the following equation:

$$SA = 2 \times Q_2/0.00096$$

or

2080 square feet per cfs of inflow

See BMP C240: Sediment Trap for more information on the above equation.

The basic geometry of the pond can now be determined using the following design criteria:

- Required surface area SA (from the equation above) at the top of the riser.
- Minimum 3.5-foot depth from the top of the riser to the bottom of the pond.

- Maximum 3H:1V interior side slopes and maximum 2H:1V exterior slopes. The interior slopes can be increased to a maximum of 2H:1V if fencing is provided at or above the maximum water surface.
- One foot of freeboard between the top of the riser and the crest of the emergency spillway.
- Flat bottom.
- Minimum 1-foot deep spillway.
- Length-to-width ratio between 3:1 and 6:1.

Sediment Pond Discharge

The outlet for the pond consists of a combination of principal and emergency spillways. These outlets must pass the peak runoff expected from the contributing drainage area for a 100-year storm. If, due to site conditions and basin geometry, a separate emergency spillway is not feasible, the principal spillway must pass the entire peak runoff expected from the 100-year storm. However, an attempt to provide a separate emergency spillway should always be made. Base the runoff calculations on the site conditions during construction. The flow through the dewatering orifice cannot be utilized when calculating the 100-year storm elevation because of its potential to become clogged; therefore, available spillway storage must begin at the principal spillway riser crest.

The principal spillway designed by the procedures described below will result in some reduction in the peak rate of runoff. However, the design will not control the discharge flow rates to the extent required to comply with I-3.4.7 MR7: Flow Control. The size of the contributing basin, the expected life of the construction project, the anticipated downstream effects, and the anticipated weather conditions during construction should be considered to determine the need for additional discharge control.

Principal Spillway: Determine the required diameter for the principal spillway (riser pipe). The diameter shall be the minimum necessary to pass the peak volumetric flow rate using a 15-minute time step from a Type 1A, 10-year, 24-hour frequency storm for the developed condition. Use Figure II-3.31: Riser Inflow Curves to determine the riser diameter.

To aid in determining sediment depth, one-foot intervals shall be prominently marked on the riser.

Emergency Overflow Spillway: Size the emergency overflow spillway for the peak volumetric flow rate using a 10-minute time step from a Type 1A, 100-year, 24-hour frequency storm for the developed condition. See BMP D.1: Detention Ponds for additional guidance for Emergency Overflow Spillway design

Dewatering Orifice: Size of the dewatering orifice(s) (minimum 1-inch diameter) using a modified version of the discharge equation for a vertical orifice and a basic equation for the area of a circular orifice. Determine the required area of the orifice with the following equation:

$$A_o = \frac{A_S(2h)^{0.5}}{0.6 \times 3600 T g^{0.5}}$$

where

A_o = orifice area (square feet)

A_S = pond surface area (square feet)

h = head of water above orifice (height of riser in feet)

T = dewatering time (24 hours)

g = acceleration of gravity (32.2 feet/second^2)

Convert the orifice area (in square feet) to the orifice diameter D (in inches):

$$D = 24 \times \sqrt{\frac{A_o}{\pi}} = 13.54 \times \sqrt{A_o}$$

The vertical, perforated tubing connected to the dewatering orifice must be at least 2 inches larger in diameter than the orifice to improve flow characteristics. The size and number of perforations in the tubing should be large enough so that the tubing does not restrict flow. The orifice should control the flow rate.

Figure II-3.28: Sediment Pond Plan View

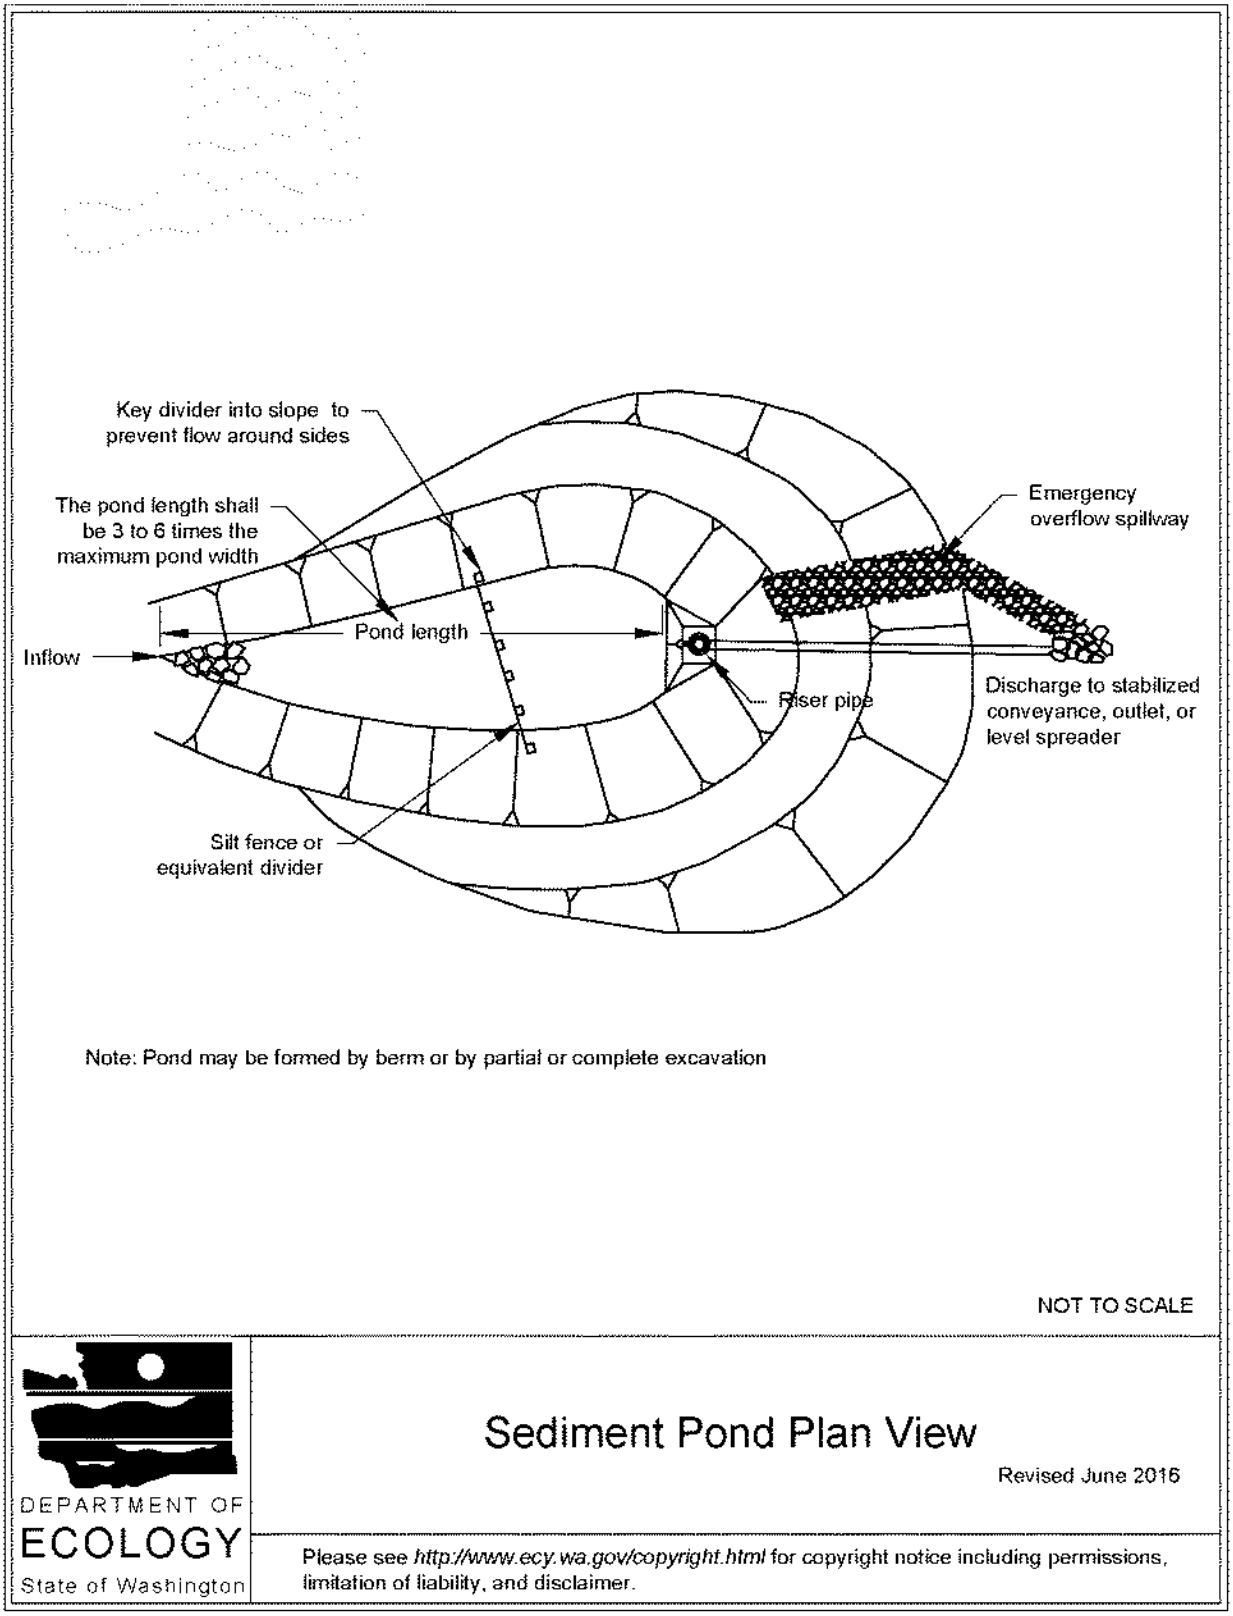


Figure II-3.29: Sediment Pond Cross Section

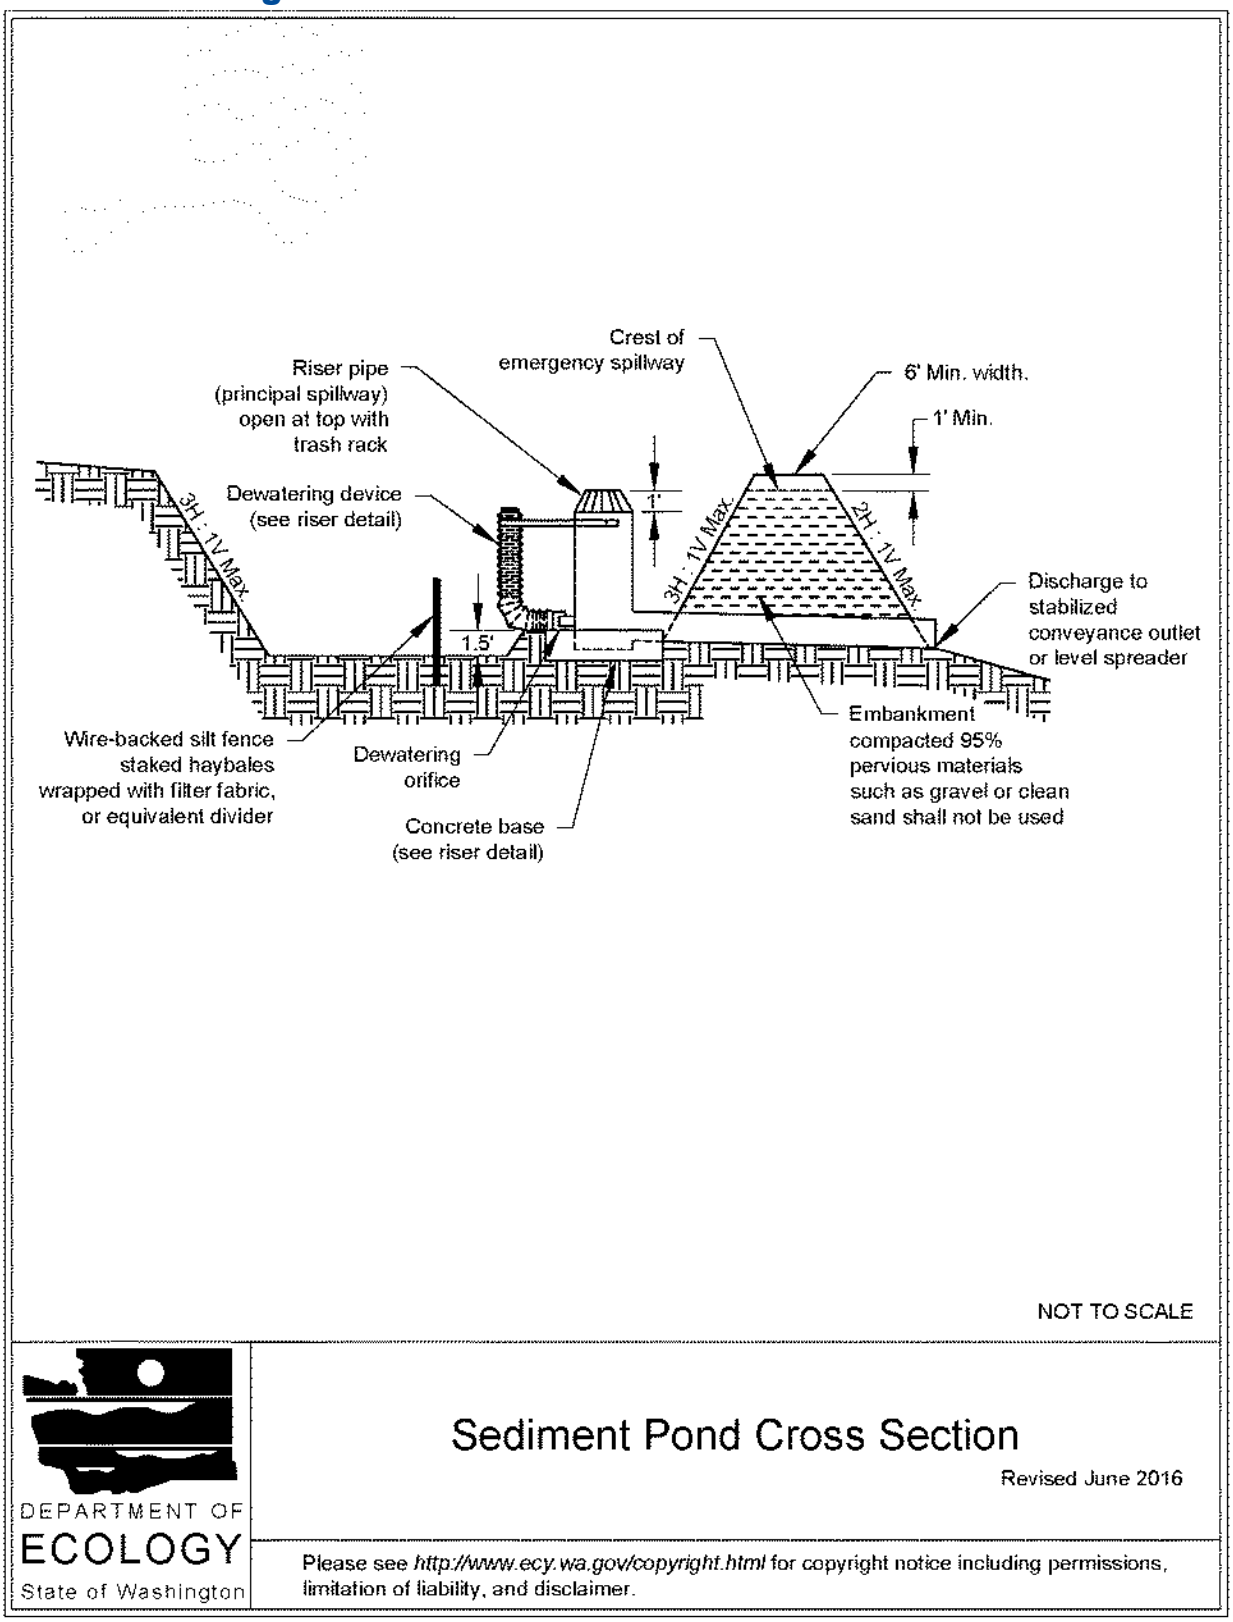


Figure II-3.30: Sediment Pond Riser Detail


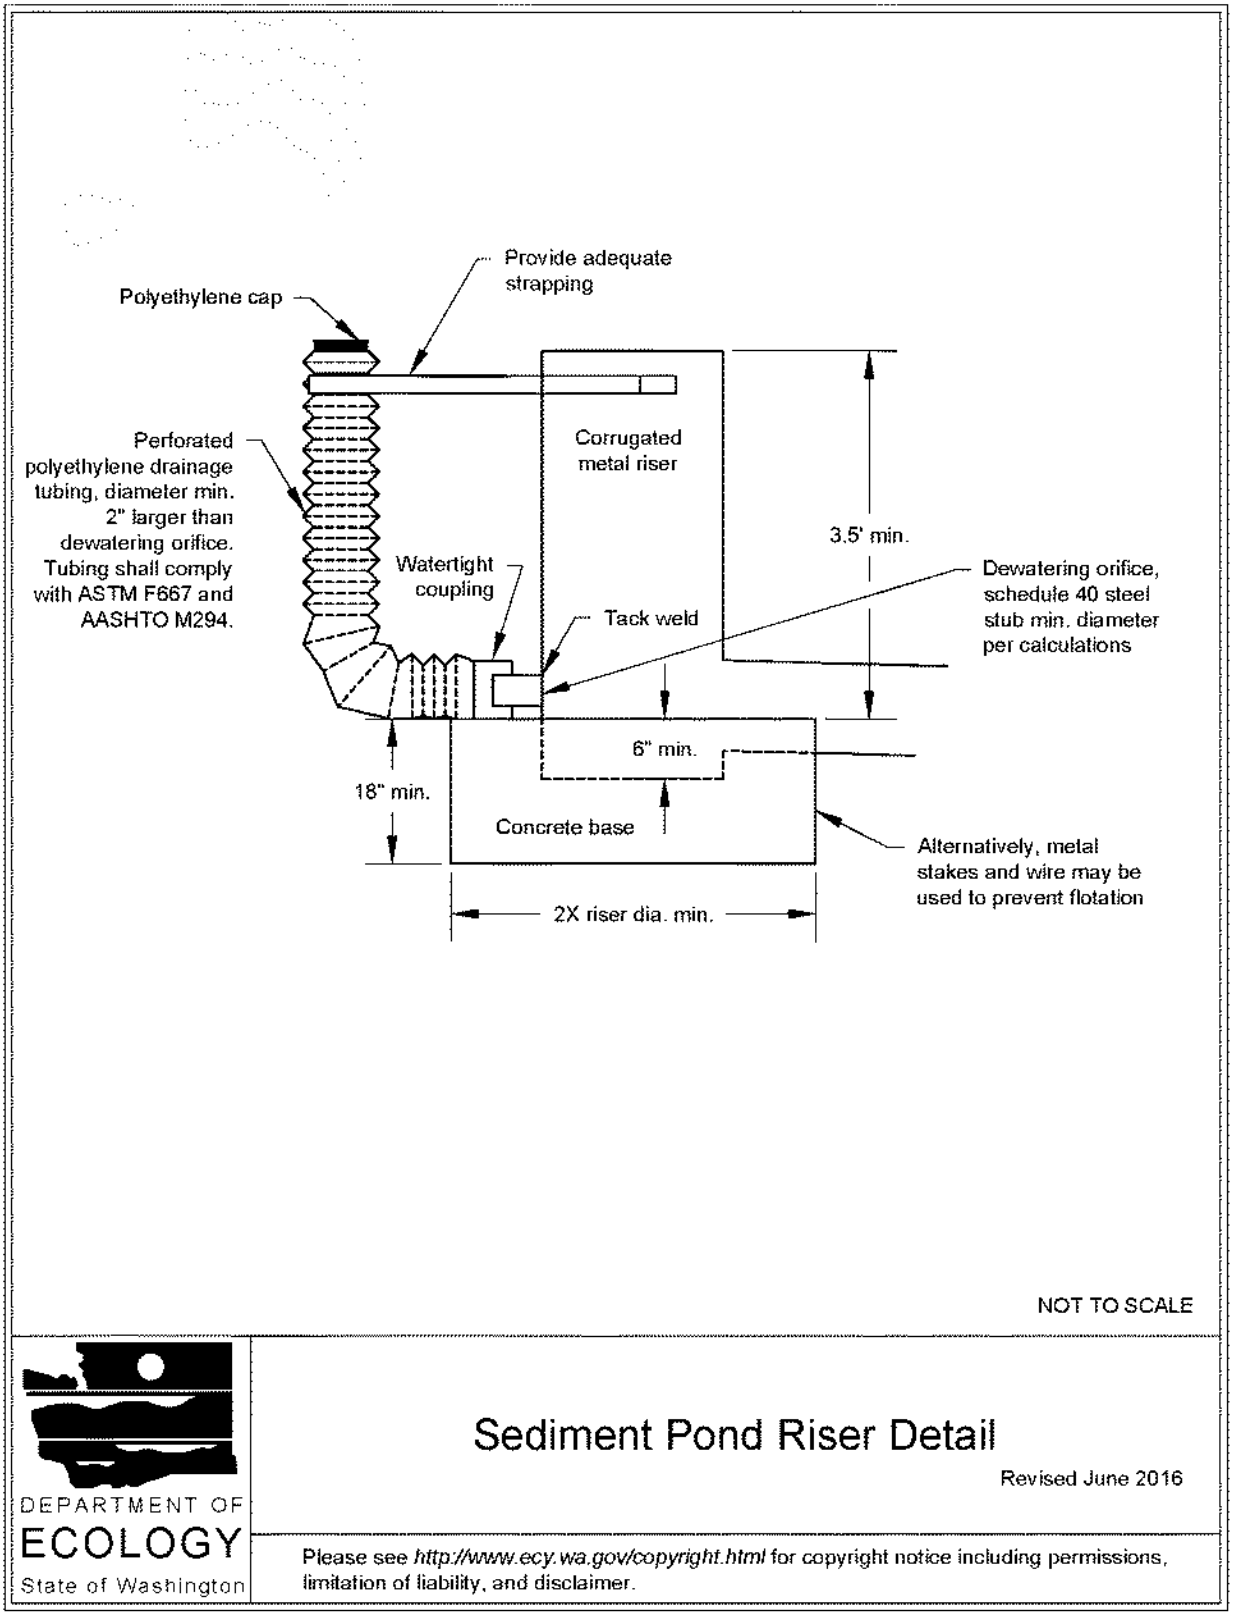


Figure II-3.31: Riser Inflow Curves

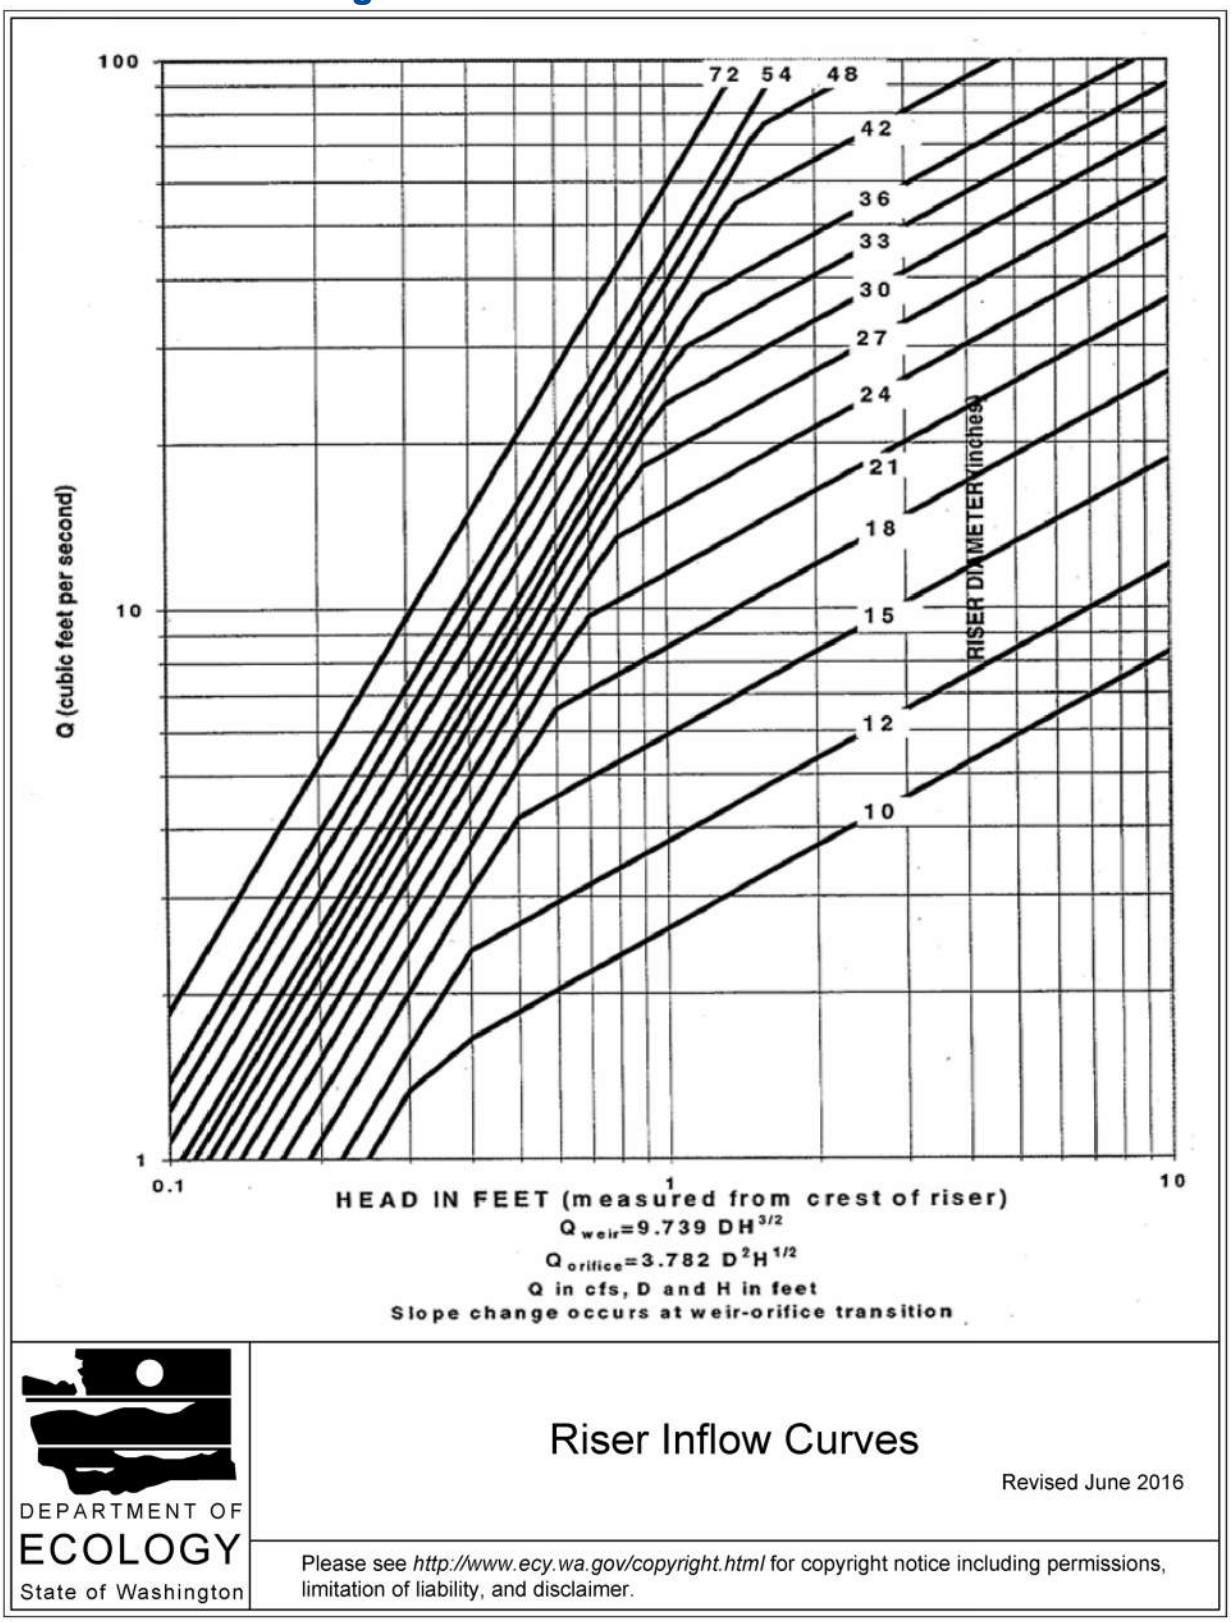

Please see *http://www.ecy.wa.gov/copyright.html* for copyright notice including permissions, limitation of liability, and disclaimer.

Maintenance Standards

- Remove sediment from the pond when it reaches 1 foot in depth.
- Repair any damage to the pond embankments or slopes.

APPENDIX C

APPENDIX D

Construction Stormwater Site Inspection Form

Project Name _____ Permit # _____ Inspection Date _____ Time _____

Name of Certified Erosion Sediment Control Lead (CESCL) or qualified inspector if *less than one acre*
Print Name: _____

Approximate rainfall amount since the last inspection (in inches): _____

Approximate rainfall amount in the last 24 hours (in inches): _____

Current Weather Clear ☐ Cloudy ☐ Mist ☐ Rain ☐ Wind ☐ Fog ☐

A. Type of inspection: Weekly ☐ Post Storm Event ☐ Other ☐

B. Phase of Active Construction (*check all that apply*):

Pre Construction/installation of erosion/sediment controls ☐	Clearing/Demo/Grading ☐	Infrastructure/storm/roads ☐
Concrete pours ☐	Vertical Construction/buildings ☐	Utilities ☐
Offsite improvements ☐	Site temporary stabilized ☐	Final stabilization ☐

C. Questions:

1. Were all areas of construction and discharge points inspected? Yes ___ No ___
2. Did you observe the presence of suspended sediment, turbidity, discoloration, or oil sheen Yes ___ No ___
3. Was a water quality sample taken during inspection? (*refer to permit conditions S4 & S5*) Yes ___ No ___
4. Was there a turbid discharge 250 NTU or greater, or Transparency 6 cm or less?* Yes ___ No ___
5. If yes to #4 was it reported to Ecology? Yes ___ No ___
6. Is pH sampling required? pH range required is 6.5 to 8.5. Yes ___ No ___

If answering yes to a discharge, describe the event. Include when, where, and why it happened; what action was taken, and when.

_____

_____

_____

_____

*If answering yes to # 4 record NTU/Transparency with continual sampling daily until turbidity is 25 NTU or less/ transparency is 33 cm or greater.

Sampling Results: Date: _____

Parameter	Method (circle one)	Result			Other/Note
		NTU	cm	pH	
Turbidity	tube, meter, laboratory				
pH	Paper, kit, meter				

Construction Stormwater Site Inspection Form

D. Check the observed status of all items. Provide "Action Required "details and dates.

Element #	Inspection	BMPs Inspected			BMP needs maintenance	BMP failed	Action required (describe in section F)
		yes	no	n/a			
1 Clearing Limits	Before beginning land disturbing activities are all clearing limits, natural resource areas (streams, wetlands, buffers, trees) protected with barriers or similar BMPs? (high visibility recommended)						
2 Construction Access	Construction access is stabilized with quarry spalls or equivalent BMP to prevent sediment from being tracked onto roads?						
	Sediment tracked onto the road way was cleaned thoroughly at the end of the day or more frequent as necessary.						
3 Control Flow Rates	Are flow control measures installed to control stormwater volumes and velocity during construction and do they protect downstream properties and waterways from erosion?						
	If permanent infiltration ponds are used for flow control during construction, are they protected from siltation?						
4 Sediment Controls	All perimeter sediment controls (e.g. silt fence, wattles, compost socks, berms, etc.) installed, and maintained in accordance with the Stormwater Pollution Prevention Plan (SWPPP).						
	Sediment control BMPs (sediment ponds, traps, filters etc.) have been constructed and functional as the first step of grading.						
	Stormwater runoff from disturbed areas is directed to sediment removal BMP.						
5 Stabilize Soils	Have exposed un-worked soils been stabilized with effective BMP to prevent erosion and sediment deposition?						

Construction Stormwater Site Inspection Form

Element #	Inspection	BMPs Inspected			BMP needs maintenance	BMP failed	Action required (describe in section F)
		yes	no	n/a			
5 Stabilize Soils Cont.	Are stockpiles stabilized from erosion, protected with sediment trapping measures and located away from drain inlet, waterways, and drainage channels?						
	Have soils been stabilized at the end of the shift, before a holiday or weekend if needed based on the weather forecast?						
6 Protect Slopes	Has stormwater and ground water been diverted away from slopes and disturbed areas with interceptor dikes, pipes and or swales?						
	Is off-site storm water managed separately from stormwater generated on the site?						
	Is excavated material placed on uphill side of trenches consistent with safety and space considerations?						
	Have check dams been placed at regular intervals within constructed channels that are cut down a slope?						
7 Drain Inlets	Storm drain inlets made operable during construction are protected.						
	Are existing storm drains within the influence of the project protected?						
8 Stabilize Channel and Outlets	Have all on-site conveyance channels been designed, constructed and stabilized to prevent erosion from expected peak flows?						
	Is stabilization, including armoring material, adequate to prevent erosion of outlets, adjacent stream banks, slopes and downstream conveyance systems?						
9 Control Pollutants	Are waste materials and demolition debris handled and disposed of to prevent contamination of stormwater?						
	Has cover been provided for all chemicals, liquid products, petroleum products, and other material?						
	Has secondary containment been provided capable of containing 110% of the volume?						
	Were contaminated surfaces cleaned immediately after a spill incident?						
	Were BMPs used to prevent contamination of stormwater by a pH modifying sources?						

Construction Stormwater Site Inspection Form

Element #	Inspection	BMPs Inspected			BMP needs maintenance	BMP failed	Action required (describe in section F)
		yes	no	n/a			
9 Cont.	Wheel wash wastewater is handled and disposed of properly.						
10 Control Dewatering	Concrete washout in designated areas. No washout or excess concrete on the ground.						
	Dewatering has been done to an approved source and in compliance with the SWPPP.						
	Were there any clean non turbid dewatering discharges?						
11 Maintain BMP	Are all temporary and permanent erosion and sediment control BMPs maintained to perform as intended?						
12 Manage the Project	Has the project been phased to the maximum degree practicable?						
	Has regular inspection, monitoring and maintenance been performed as required by the permit?						
	Has the SWPPP been updated, implemented and records maintained?						

E. Check all areas that have been inspected. ✔

All in place BMPs ☐ All disturbed soils ☐ All concrete wash out area ☐ All material storage areas ☐
All discharge locations ☐ All equipment storage areas ☐ All construction entrances/exits ☐

F. Elements checked "Action Required" (section D) describe corrective action to be taken. List the element number; be specific on location and work needed. Document, initial, and date when the corrective action has been completed and inspected.

Element #	Description and Location	Action Required	Completion Date	Initials

Attach additional page if needed

Sign the following certification:

"I certify that this report is true, accurate, and complete, to the best of my knowledge and belief"

Inspected by: (print) _____ (Signature) _____ Date: _____

Title/Qualification of Inspector: _____

APPENDIX E

APPENDIX F

APPENDIX G

APPENDIX H

Tab 9.0

9.0 OPERATIONS AND MAINTENANCE MANUAL

9.0 OPERATION AND MAINTENANCE MANUAL

See below for operation and maintenance requirements for flow control facilities, water quality facilities, and conveyance systems from the DOE SWMM. This section shall be updated as needed to reflect all chosen BMPs.

NO. 3 – DETENTION TANKS AND VAULTS

Maintenance Component	Defect or Problem	Conditions When Maintenance is Needed	Results Expected When Maintenance is Performed
Site	Trash and debris	Any trash and debris which exceed 1 cubic foot per 1,000 square feet (this is about equal to the amount of trash it would take to fill up one standard size office garbage can). In general, there should be no visual evidence of dumping.	Trash and debris cleared from site.
	Noxious weeds	Any noxious or nuisance vegetation which may constitute a hazard to County personnel or the public.	Noxious and nuisance vegetation removed according to applicable regulations. No danger of noxious vegetation where County personnel or the public might normally be.
	Contaminants and pollution	Any evidence of contaminants or pollution such as oil, gasoline, concrete slurries or paint.	Materials removed and disposed of according to applicable regulations. Source control BMPs implemented if appropriate. No contaminants present other than a surface oil film.
	Grass/groundcover	Grass or groundcover exceeds 18 inches in height.	Grass or groundcover mowed to a height no greater than 6 inches.
Tank or Vault Storage Area	Trash and debris	Any trash and debris accumulated in vault or tank (includes floatables and non-floatables).	No trash or debris in vault.
	Sediment accumulation	Accumulated sediment depth exceeds 10% of the diameter of the storage area for ½ length of storage vault or any point depth exceeds 15% of diameter. Example: 72-inch storage tank would require cleaning when sediment reaches depth of 7 inches for more than ½ length of tank.	All sediment removed from storage area.
Tank Structure	Plugged air vent	Any blockage of the vent.	Tank or vault freely vents.
	Tank bent out of shape	Any part of tank/pipe is bent out of shape more than 10% of its design shape.	Tank repaired or replaced to design.
	Gaps between sections, damaged joints or cracks or tears in wall	A gap wider than ½-inch at the joint of any tank sections or any evidence of soil particles entering the tank at a joint or through a wall.	No water or soil entering tank through joints or walls.
Vault Structure	Damage to wall, frame, bottom, and/or top slab	Cracks wider than ½-inch, any evidence of soil entering the structure through cracks or qualified inspection personnel determines that the vault is not structurally sound.	Vault is sealed and structurally sound.
Inlet/Outlet Pipes	Sediment accumulation	Sediment filling 20% or more of the pipe.	Inlet/outlet pipes clear of sediment.
	Trash and debris	Trash and debris accumulated in inlet/outlet pipes (includes floatables and non-floatables).	No trash or debris in pipes.
	Damaged	Cracks wider than ½-inch at the joint of the inlet/outlet pipes or any evidence of soil entering at the joints of the inlet/outlet pipes.	No cracks more than ¼-inch wide at the joint of the inlet/outlet pipe.

NO. 3 – DETENTION TANKS AND VAULTS

Maintenance Component	Defect or Problem	Conditions When Maintenance is Needed	Results Expected When Maintenance is Performed
Access Manhole	Cover/lid not in place	Cover/lid is missing or only partially in place. **Any open manhole requires immediate maintenance.**	Manhole access covered.
	Locking mechanism not working	Mechanism cannot be opened by one maintenance person with proper tools. Bolts cannot be seated. Self-locking cover/lid does not work.	Mechanism opens with proper tools.
	Cover/lid difficult to remove	One maintenance person cannot remove cover/lid after applying 80 lbs of lift.	Cover/lid can be removed and reinstalled by one maintenance person.
	Ladder rungs unsafe	Missing rungs, misalignment, rust, or cracks.	Ladder meets design standards. Allows maintenance person safe access.
Large access doors/plate	Damaged or difficult to open	Large access doors or plates cannot be opened/removed using normal equipment.	Replace or repair access door so it can opened as designed.
	Gaps, doesn't cover completely	Large access doors not flat and/or access opening not completely covered.	Doors close flat; covers access opening completely.
	Lifting Rings missing, rusted	Lifting rings not capable of lifting weight of door or plate.	Lifting rings sufficient to lift or remove door or plate.

NO. 5 – CATCH BASINS AND MANHOLES

Maintenance Component	Defect or Problem	Condition When Maintenance is Needed	Results Expected When Maintenance is Performed
Structure	Sediment	Sediment exceeds 60% of the depth from the bottom of the catch basin to the invert of the lowest pipe into or out of the catch basin or is within 6 inches of the invert of the lowest pipe into or out of the catch basin.	Sump of catch basin contains no sediment.
	Trash and debris	Trash or debris of more than ½ cubic foot which is located immediately in front of the catch basin opening or is blocking capacity of the catch basin by more than 10%.	No Trash or debris blocking or potentially blocking entrance to catch basin.
		Trash or debris in the catch basin that exceeds $^1/_3$ the depth from the bottom of basin to invert the lowest pipe into or out of the basin.	No trash or debris in the catch basin.
		Dead animals or vegetation that could generate odors that could cause complaints or dangerous gases (e.g., methane).	No dead animals or vegetation present within catch basin.
		Deposits of garbage exceeding 1 cubic foot in volume.	No condition present which would attract or support the breeding of insects or rodents.
	Damage to frame and/or top slab	Corner of frame extends more than ¾ inch past curb face into the street (If applicable).	Frame is even with curb.
		Top slab has holes larger than 2 square inches or cracks wider than ¼ inch.	Top slab is free of holes and cracks.
		Frame not sitting flush on top slab, i.e., separation of more than ¾ inch of the frame from the top slab.	Frame is sitting flush on top slab.
	Cracks in walls or bottom	Cracks wider than ½ inch and longer than 3 feet, any evidence of soil particles entering catch basin through cracks, or maintenance person judges that catch basin is unsound.	Catch basin is sealed and is structurally sound.
		Cracks wider than ½ inch and longer than 1 foot at the joint of any inlet/outlet pipe or any evidence of soil particles entering catch basin through cracks.	No cracks more than $^1/_4$ inch wide at the joint of inlet/outlet pipe.
	Settlement/ misalignment	Catch basin has settled more than 1 inch or has rotated more than 2 inches out of alignment.	Basin replaced or repaired to design standards.
	Damaged pipe joints	Cracks wider than ½-inch at the joint of the inlet/outlet pipes or any evidence of soil entering the catch basin at the joint of the inlet/outlet pipes.	No cracks more than ¼-inch wide at the joint of inlet/outlet pipes.
	Contaminants and pollution	Any evidence of contaminants or pollution such as oil, gasoline, concrete slurries or paint.	Materials removed and disposed of according to applicable regulations. Source control BMPs implemented if appropriate. No contaminants present other than a surface oil film.
Inlet/Outlet Pipe	Sediment accumulation	Sediment filling 20% or more of the pipe.	Inlet/outlet pipes clear of sediment.
	Trash and debris	Trash and debris accumulated in inlet/outlet pipes (includes floatables and non-floatables).	No trash or debris in pipes.

	Damaged	Cracks wider than ½-inch at the joint of the inlet/outlet pipes or any evidence of soil entering at the joints of the inlet/outlet pipes.	No cracks more than ¼-inch wide at the joint of the inlet/outlet pipe.

NO. 5 – CATCH BASINS AND MANHOLES

Maintenance Component	Defect or Problem	Condition When Maintenance is Needed	Results Expected When Maintenance is Performed
Metal Grates (Catch Basins)	Unsafe grate opening	Grate with opening wider than $^{7}/_{8}$ inch.	Grate opening meets design standards.
	Trash and debris	Trash and debris that is blocking more than 20% of grate surface.	Grate free of trash and debris. footnote to guidelines for disposal
	Damaged or missing	Grate missing or broken member(s) of the grate. **Any open structure requires urgent maintenance**.	Grate is in place and meets design standards.
Manhole Cover/Lid	Cover/lid not in place	Cover/lid is missing or only partially in place. **Any open structure requires urgent maintenance**.	Cover/lid protects opening to structure.
	Locking mechanism Not Working	Mechanism cannot be opened by one maintenance person with proper tools. Bolts cannot be seated. Self-locking cover/lid does not work.	Mechanism opens with proper tools.
	Cover/lid difficult to Remove	One maintenance person cannot remove cover/lid after applying 80 lbs. of lift.	Cover/lid can be removed and reinstalled by one maintenance person.

NO. 6 – CONVEYANCE PIPES AND DITCHES

Maintenance Component	Defect or Problem	Conditions When Maintenance is Needed	Results Expected When Maintenance is Performed
Pipes	Sediment & debris accumulation	Accumulated sediment or debris that exceeds 20% of the diameter of the pipe.	Water flows freely through pipes.
	Vegetation/roots	Vegetation/roots that reduce free movement of water through pipes.	Water flows freely through pipes.
	Contaminants and pollution	Any evidence of contaminants or pollution such as oil, gasoline, concrete slurries or paint.	Materials removed and disposed of according to applicable regulations. Source control BMPs implemented if appropriate. No contaminants present other than a surface oil film.
	Damage to protective coating or corrosion	Protective coating is damaged; rust or corrosion is weakening the structural integrity of any part of pipe.	Pipe repaired or replaced.
	Damaged	Any dent that decreases the cross section area of pipe by more than 20% or is determined to have weakened structural integrity of the pipe.	Pipe repaired or replaced.
Ditches	Trash and debris	Trash and debris exceeds 1 cubic foot per 1,000 square feet of ditch and slopes.	Trash and debris cleared from ditches.
	Sediment accumulation	Accumulated sediment that exceeds 20% of the design depth.	Ditch cleaned/flushed of all sediment and debris so that it matches design.
	Noxious weeds	Any noxious or nuisance vegetation which may constitute a hazard to County personnel or the public.	Noxious and nuisance vegetation removed according to applicable regulations. No danger of noxious vegetation where County personnel or the public might normally be.
	Contaminants and pollution	Any evidence of contaminants or pollution such as oil, gasoline, concrete slurries or paint.	Materials removed and disposed of according to applicable regulations. Source control BMPs implemented if appropriate. No contaminants present other than a surface oil film.
	Vegetation	Vegetation that reduces free movement of water through ditches.	Water flows freely through ditches.
	Erosion damage to slopes	Any erosion observed on a ditch slope.	Slopes are not eroding.
	Rock lining out of place or missing (If Applicable)	One layer or less of rock exists above native soil area 5 square feet or more, any exposed native soil.	Replace rocks to design standards.

NO. 8 – ENERGY DISSIPATERS

Maintenance Component	Defect or Problem	Conditions When Maintenance is Needed	Results Expected When Maintenance is Performed.
Site	Trash and debris	Trash and/or debris accumulation.	Dissipater clear of trash and/or debris.
	Contaminants and pollution	Any evidence of contaminants or pollution such as oil, gasoline, concrete slurries or paint.	Materials removed and disposed of according to applicable regulations. Source control BMPs implemented if appropriate. No contaminants present other than a surface oil film.
Rock Pad	Missing or moved Rock	Only one layer of rock exists above native soil in area five square feet or larger or any exposure of native soil.	Rock pad prevents erosion.
Dispersion Trench	Pipe plugged with sediment	Accumulated sediment that exceeds 20% of the design depth.	Pipe cleaned/flushed so that it matches design.
	Not discharging water properly	Visual evidence of water discharging at concentrated points along trench (normal condition is a “sheet flow” of water along trench).	Water discharges from feature by sheet flow.
	Perforations plugged.	Over 1/4 of perforations in pipe are plugged with debris or sediment.	Perforations freely discharge flow.
	Water flows out top of “distributor” catch basin.	Water flows out of distributor catch basin during any storm less than the design storm.	No flow discharges from distributor catch basin.
	Receiving area over-saturated	Water in receiving area is causing or has potential of causing landslide problems.	No danger of landslides.
Gabions	Damaged mesh	Mesh of gabion broken, twisted or deformed so structure is weakened or rock may fall out.	Mesh is intact, no rock missing.
	Corrosion	Gabion mesh shows corrosion through more than ¼ of its gage.	All gabion mesh capable of containing rock and retaining designed form.
	Collapsed or deformed baskets	Gabion basket shape deformed due to any cause.	All gabion baskets intact, structure stands as designed.
	Missing rock	Any rock missing that could cause gabion to loose structural integrity.	No rock missing.
Manhole/Chamber	Worn or damaged post, baffles or side of chamber	Structure dissipating flow deteriorates to ½ or original size or any concentrated worn spot exceeding one square foot which would make structure unsound.	Structure is in no danger of failing.
	Damage to wall, frame, bottom, and/or top slab	Cracks wider than ½-inch or any evidence of soil entering the structure through cracks, or maintenance inspection personnel determines that the structure is not structurally sound.	Manhole/chamber is sealed and structurally sound.
	Damaged pipe joints	Cracks wider than ½-inch at the joint of the inlet/outlet pipes or any evidence of soil entering the structure at the joint of the inlet/outlet pipes.	No soil or water enters and no water discharges at the joint of inlet/outlet pipes.

NO. 9 – FENCING

Maintenance Component	Defect or Problem	Conditions When Maintenance is Needed	Results Expected When Maintenance is Performed
Site	Erosion or holes under fence	Erosion or holes more than 4 inches high and 12-18 inches wide permitting access through an opening under a fence.	No access under the fence.
Wood Posts, Boards and Cross Members	Missing or damaged parts	Missing or broken boards, post out of plumb by more than 6 inches or cross members broken	No gaps on fence due to missing or broken boards, post plumb to within 1½ inches, cross members sound.
	Weakened by rotting or insects	Any part showing structural deterioration due to rotting or insect damage	All parts of fence are structurally sound.
	Damaged or failed post foundation	Concrete or metal attachments deteriorated or unable to support posts.	Post foundation capable of supporting posts even in strong wind.
Metal Posts, Rails and Fabric	Damaged parts	Post out of plumb more than 6 inches.	Post plumb to within 1½ inches.
		Top rails bent more than 6 inches.	Top rail free of bends greater than 1 inch.
		Any part of fence (including post, top rails, and fabric) more than 1 foot out of design alignment.	Fence is aligned and meets design standards.
		Missing or loose tension wire.	Tension wire in place and holding fabric.
	Deteriorated paint or protective coating	Part or parts that have a rusting or scaling condition that has affected structural adequacy.	Structurally adequate posts or parts with a uniform protective coating.
	Openings in fabric	Openings in fabric are such that an 8-inch diameter ball could fit through.	Fabric mesh openings within 50% of grid size.

NO. 10 – GATES/BOLLARDS/ACCESS BARRIERS

Maintenance Component	Defect or Problem	Conditions When Maintenance is Needed	Results Expected When Maintenance is Performed
Chain Link Fencing Gate	Damaged or missing members	Missing gate.	Gates in place.
		Broken or missing hinges such that gate cannot be easily opened and closed by a maintenance person.	Hinges intact and lubed. Gate is working freely.
		Gate is out of plumb more than 6 inches and more than 1 foot out of design alignment.	Gate is aligned and vertical.
		Missing stretcher bar, stretcher bands, and ties.	Stretcher bar, bands, and ties in place.
	Locking mechanism does not lock gate	Locking device missing, no-functioning or does not link to all parts.	Locking mechanism prevents opening of gate.
	Openings in fabric	Openings in fabric are such that an 8-inch diameter ball could fit through.	Fabric mesh openings within 50% of grid size.
Bar Gate	Damaged or missing cross bar	Cross bar does not swing open or closed, is missing or is bent to where it does not prevent vehicle access.	Cross bar swings fully open and closed and prevents vehicle access.
	Locking mechanism does not lock gate	Locking device missing, no-functioning or does not link to all parts.	Locking mechanism prevents opening of gate.
	Support post damaged	Support post does not hold cross bar up.	Cross bar held up preventing vehicle access into facility.
Bollards	Damaged or missing	Bollard broken, missing, does not fit into support hole or hinge broken or missing.	No access for motorized vehicles to get into facility.
	Does not lock	Locking assembly or lock missing or cannot be attached to lock bollard in place.	No access for motorized vehicles to get into facility.
Boulders	Dislodged	Boulders not located to prevent motorized vehicle access.	No access for motorized vehicles to get into facility.
	Circumvented	Motorized vehicles going around or between boulders.	No access for motorized vehicles to get into facility.

NO. 11 – GROUNDS (LANDSCAPING)

Maintenance Component	Defect or Problem	Conditions When Maintenance is Needed	Results Expected When Maintenance is Performed
Site	Trash or litter	Any trash and debris which exceed 1 cubic foot per 1,000 square feet (this is about equal to the amount of trash it would take to fill up one standard size office garbage can). In general, there should be no visual evidence of dumping.	Trash and debris cleared from site.
	Noxious weeds	Any noxious or nuisance vegetation which may constitute a hazard to County personnel or the public.	Noxious and nuisance vegetation removed according to applicable regulations. No danger of noxious vegetation where County personnel or the public might normally be.
	Contaminants and pollution	Any evidence of contaminants or pollution such as oil, gasoline, concrete slurries or paint.	Materials removed and disposed of according to applicable regulations. Source control BMPs implemented if appropriate. No contaminants present other than a surface oil film.
	Grass/groundcover	Grass or groundcover exceeds 18 inches in height.	Grass or groundcover mowed to a height no greater than 6 inches.
Trees and Shrubs	Hazard	Any tree or limb of a tree identified as having a potential to fall and cause property damage or threaten human life. **A hazard tree identified by a qualified arborist must be removed as soon as possible.**	No hazard trees in facility.
	Damaged	Limbs or parts of trees or shrubs that are split or broken which affect more than 25% of the total foliage of the tree or shrub.	Trees and shrubs with less than 5% of total foliage with split or broken limbs.
		Trees or shrubs that have been blown down or knocked over.	No blown down vegetation or knocked over vegetation. Trees or shrubs free of injury.
		Trees or shrubs which are not adequately supported or are leaning over, causing exposure of the roots.	Tree or shrub in place and adequately supported; dead or diseased trees removed.

NO. 12 – ACCESS ROADS

Maintenance Component	Defect or Problem	Condition When Maintenance is Needed	Results Expected When Maintenance is Performed
Site	Trash and debris	Trash and debris exceeds 1 cubic foot per 1,000 square feet (i.e., trash and debris would fill up one standards size garbage can).	Roadway drivable by maintenance vehicles.
		Debris which could damage vehicle tires or prohibit use of road.	Roadway drivable by maintenance vehicles.
	Contaminants and pollution	Any evidence of contaminants or pollution such as oil, gasoline, concrete slurries or paint.	Materials removed and disposed of according to applicable regulations. Source control BMPs implemented if appropriate. No contaminants present other than a surface oil film.
	Blocked roadway	Any obstruction which reduces clearance above road surface to less than 14 feet.	Roadway overhead clear to 14 feet high.
		Any obstruction restricting the access to a 10- to 12 foot width for a distance of more than 12 feet or any point restricting access to less than a 10 foot width.	At least 12-foot of width on access road.
Road Surface	Erosion, settlement, potholes, soft spots, ruts	Any surface defect which hinders or prevents maintenance access.	Road drivable by maintenance vehicles.
	Vegetation on road surface	Trees or other vegetation prevent access to facility by maintenance vehicles.	Maintenance vehicles can access facility.
Shoulders and Ditches	Erosion	Erosion within 1 foot of the roadway more than 8 inches wide and 6 inches deep.	Shoulder free of erosion and matching the surrounding road.
	Weeds and brush	Weeds and brush exceed 18 inches in height or hinder maintenance access.	Weeds and brush cut to 2 inches in height or cleared in such a way as to allow maintenance access.
Modular Grid Pavement	Contaminants and pollution	Any evidence of contaminants or pollution such as oil, gasoline, concrete slurries or paint.	Materials removed and disposed of according to applicable regulations. Source control BMPs implemented if appropriate. No contaminants present other than a surface oil film.
	Damaged or missing	Access surface compacted because of broken on missing modular block.	Access road surface restored so road infiltrates.

Memorandum

To: City of Fife

From: KPG Psomas

Date: 8/28/2025

Re: Review of Vector Freeman Logistics July 2025 Submittal

KPG Psomas completed a review of the Vector Freeman Logistics' updated Traffic Impact Analysis (TIA) dated July 2025, Response to Comments memo dated July 16, 2025, and site plans. This review builds upon comments previously provided on earlier versions of the TIA, technical memos on the Freeman Road E/N Levee Road E intersection, Response to Comment memos, and site plans. Our review comments are described below.

Freeman Road E/N Levee Road E Intersection

The development's proposed improvement to mitigate level of service (LOS) at the Freeman Road E/N Levee Road E intersection has been changed from all-way stop control to maintaining minor street stop control and adding a southbound left turn lane, eastbound left turn lane, and an eastbound receiving/acceleration lane for the southbound left turn lane. This is the preferred intersection improvement of the City of Fife. The improvement maintains traffic flows on N Levee Road E, provides a two-stage left turn for southbound Freeman Road E, and results in LOS D or better for all land use alternatives. While we support the intersection improvement concept, there may additional comments as the concept is designed in more detail. The design should demonstrate that there is adequate sight distance for southbound vehicles.

Union Pacific Railroad Crossing at Freeman Road E

The Freeman Road E/Valley Avenue E signalized intersection is located 170' north of the Union Pacific Railroad (UPRR) tracks. The northbound intersection approach has a 50' left turn lane and a shared through-right turn lane. The Manual on Urban Traffic Control Devices (MUTCD) 8C.09 states "If a grade crossing is equipped with flashing-light signals and is located 200 feet or less from an intersection or midblock location controlled by a traffic control signal,…, the intersection should be provided with rail preemption in accordance with Section 4F.19…."

On page 67 of the TIA, the section titled Union Pacific Rail Crossing documents that with the development, northbound queues from the Freeman Road E/Valley Avenue E signalized intersection are expected to extend past the rail crossing during the peak 5 percent of traffic. This section also states "If the Development will need a condition of occupancy before WSDOT starts construction of Freeman Road, then the Development will install the interconnect."

Each of the development's land use alternatives are expected to generate a high number of peak hour and daily vehicle trips traveling northbound on Freeman Road E to the Freeman Road

E/Valley Avenue intersection. For example, during the PM peak hour, the Manufacturing land use alternative (140) is forecast to increase northbound traffic on Freeman Road E from 74 vehicles to 196 vehicles, a 165% increase. We agree with the finding of the TIA that railroad preemption at the Freeman Road E/Valley Avenue signalized intersection should be required as mitigation prior to the occupancy of the development.

- In Tables 6, 7, 10, 11, 14, 15, 18, and 19, the last column header is “2028 Future w/ Conditions”, to make it clear to the reader, these headers should be changed to “2028 Future w/ Development”.
- In Appendix C, the Synchro reports for No Build Conditions have incorrect headers that are labeled “Industrial Park”. Change headers to No Build Conditions.
- The volume calculation spreadsheets at the beginning of Appendices D, E, F, and G have errors in the calculation of the future volumes for the various scenarios. These incorrect volumes are not used in the Synchro calculations of intersection level of service and delay and do not affect the results of the analysis. These volume spreadsheets should be corrected.